




ASPHALT SHINGLES
12"FINISHED OH.
R.T.M.C.
2X6 EXTERIOR WALLS
2X6 FASCIA BOARD

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)

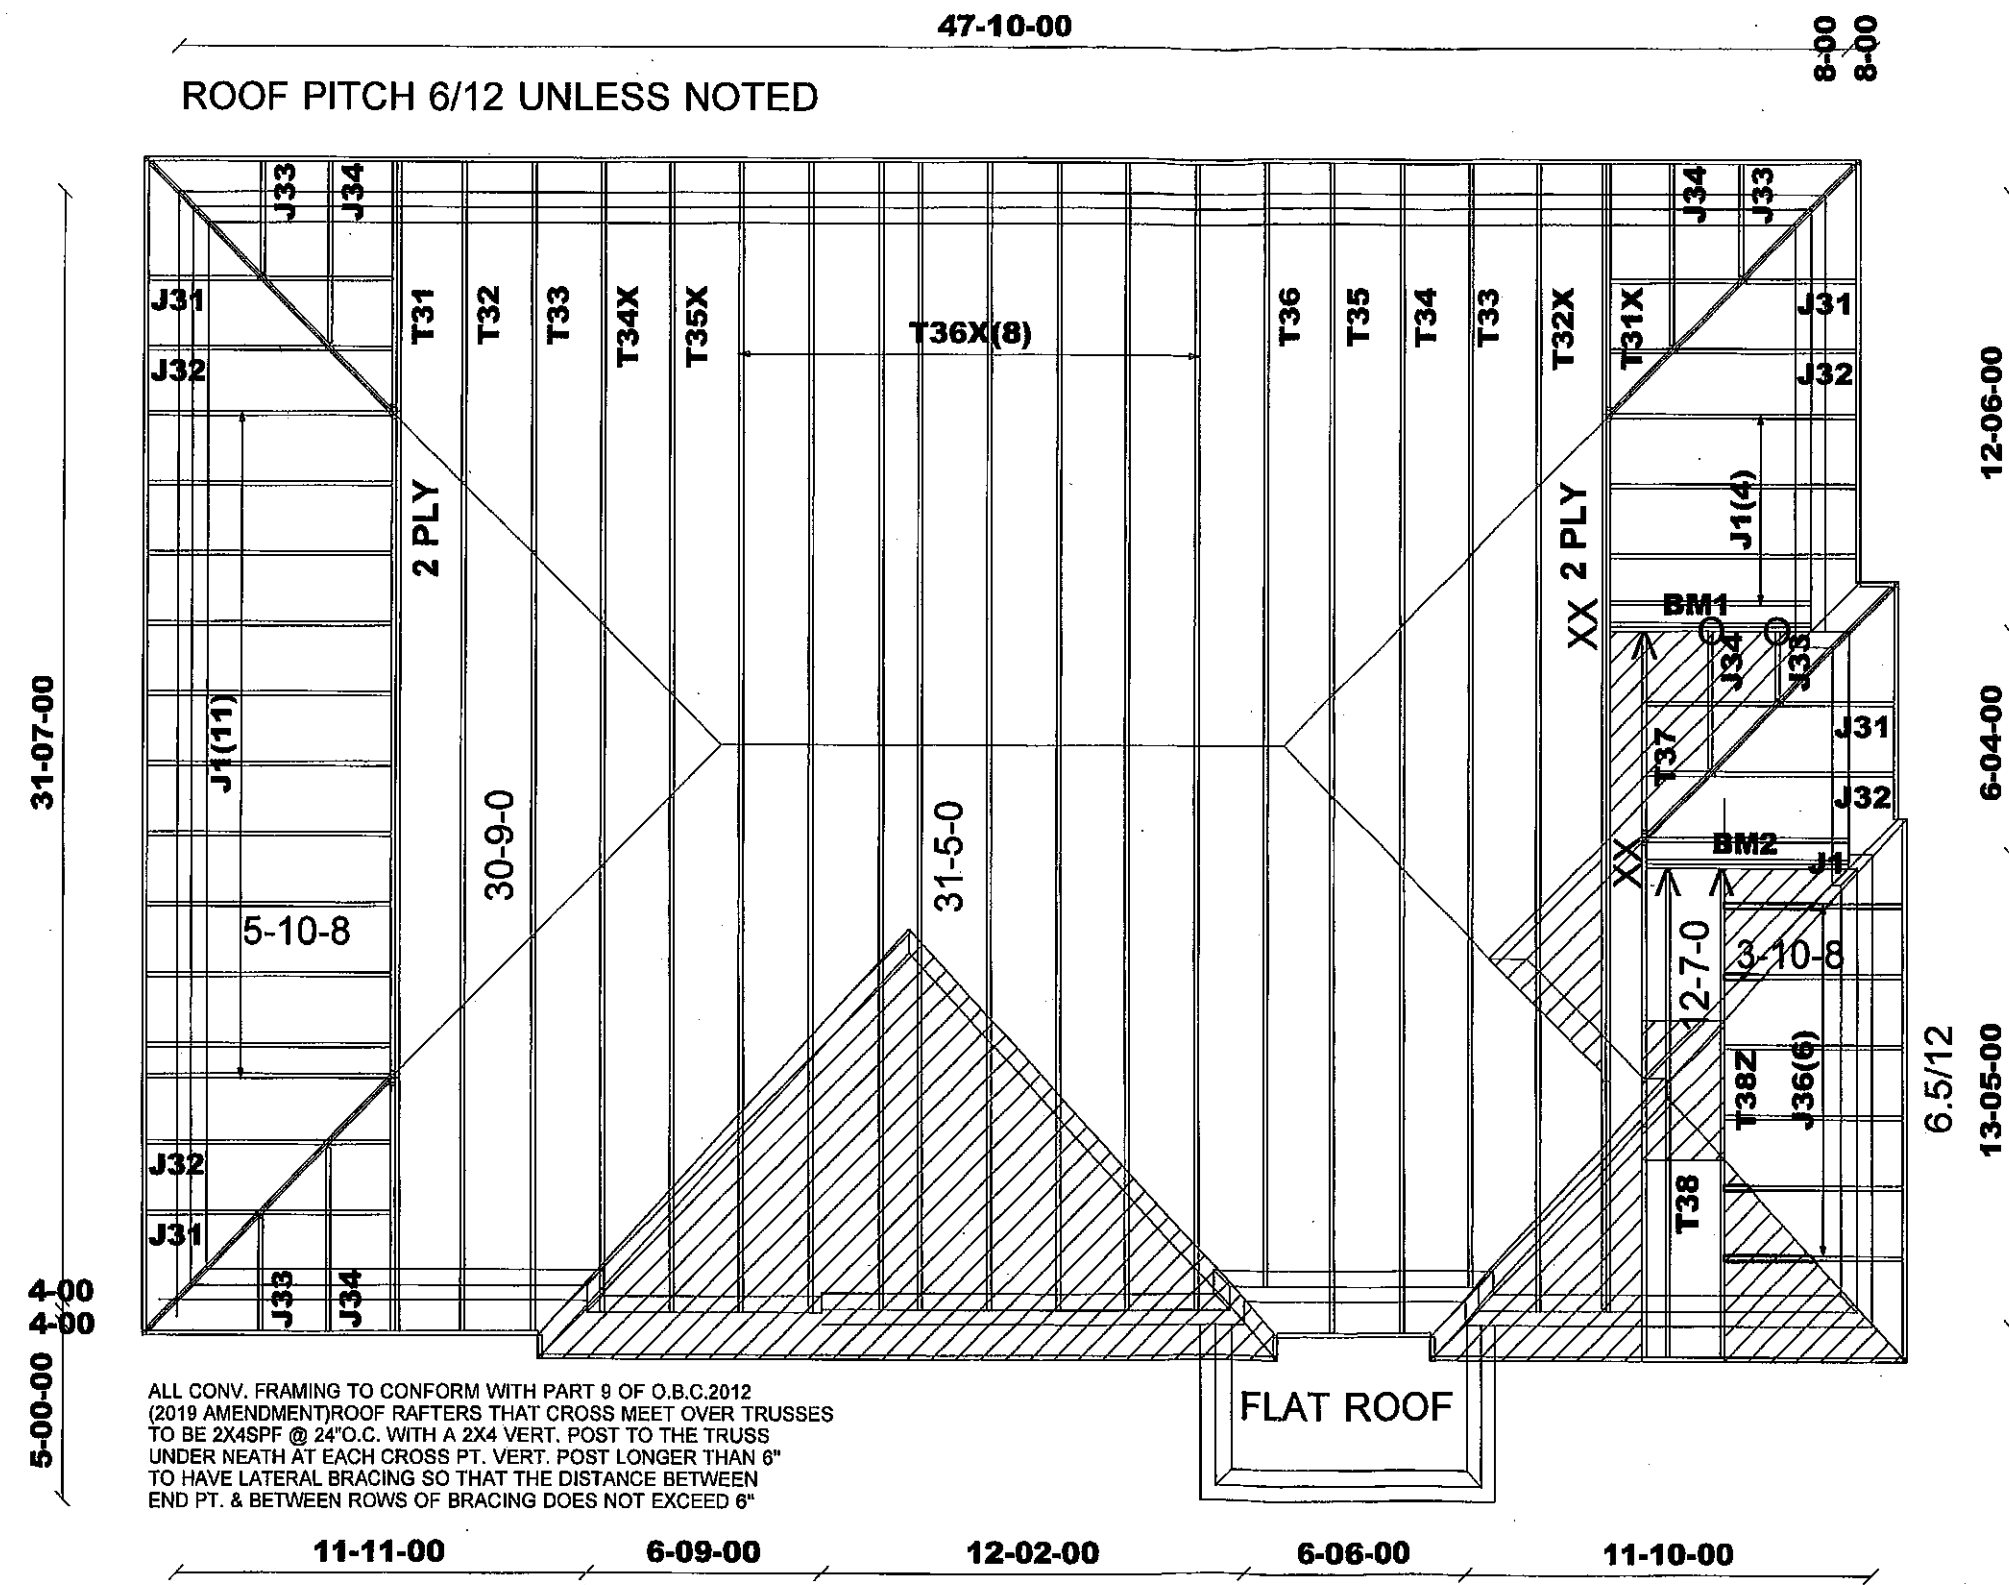

DENOTES
CONV.
FRAMING

DESIGN CONFORMS
WITH O.B.C.2012 PART 9
(2019 AMENDMENT)
DESIGN LOADS:
SNOW LOAD 25.6 PSF
TC DEAD 6 PSF
BC LIVE 0 PSF
BC DEAD 7.4 PSF

BM1, BM2 = 2-2X10

M13128




Job Track: **51225**
Plan Log: **202440**
Layout ID: **408320**

Builder / Location:
GREEN PARK HOMES / WATERDOWN
Project: **RUSSELL GARDENS PH.3**
Date: 2020-04-27 Sales: **Mario DiCano** Designer: **AC/IG**

Model / Elevation:
VALLEYCREEK 12/3 - LOT 7/

Milek ver 8.3.1.215

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

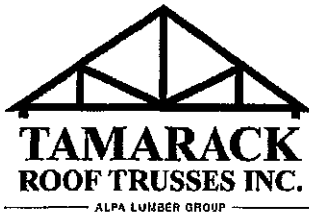


DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: VALLEYCREEK 12
 Lot #: 071
 Elevation: 3

Job Track: 51225
 PlanLog: 202440
 Layout ID: 408320
 Ref #
 Page: 1 of 2
 Date: 04-27-2020
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T31 Hip Girder	6/12	30-09-00	4-01-04	2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	322.41 204.00		
	1 2-ply	T31X Hip Girder	6/12	30-09-00	4-01-04	2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	309.5 191.33		
	1	T32 Hip	6/12	30-09-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	120.33 74.83		
	1	T32X Hip	6/12	30-09-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	120.8 75.17		
	2	T33 Hip	6/12	30-09-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	251.59 157.33		
	1	T34 Hip	6/12	30-09-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	127.28 78.67		
	1	T34X Hip	6/12	30-09-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	129.62 81.33		
	1	T35 Hip	6/12	30-09-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	128.28 80.00		
	1	T35X Hip	6/12	30-09-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	130.94 82.83		
	1	T36 Common	6/12	30-09-00	8-10-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	128.82 79.83		
	8	T36X Common	6/12	30-09-00	8-10-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1032.72 662.00		
	1	T37 Roof Special Girder	6/12	19-04-00	4-01-04	2 x 4 2 x 6	1-03-08	1-02-00 1-02-00	100.16 63.83		
	1	T38 Hip	6/12	12-07-00	3-03-14	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	49.83 32.50		
	1	T38Z Hip Girder	6/12	12-07-00	3-03-14	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	49.83 32.50		

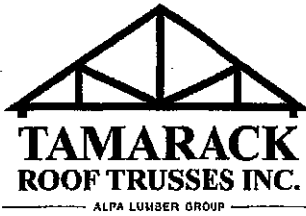

DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: VALLEYCREEK 12
 Lot #: 07/
 Elevation: 3

Job Track: 51225
 PlanLog: 202440
 Layout ID: 408320
 Ref #
 Page: 2 of 2
 Date: 04-27-2020
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	16	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	288.71 170.67		
	4	J31 Jack-Open	6 /12	1-10-15	2-01-08	2 x 4	1-03-08 3-11-09	1-02-00 2-01-08	46.97 29.33		
	4	J32 Jack-Open	6 /12	3-10-15	3-01-08	2 x 4	1-03-08 1-11-09	1-02-00 3-01-08	57.17 34.67		
	4	J33 Jack-Open	6 /12	1-10-15	2-01-08	2 x 4	1-03-08 1-01	1-02-00 2-01-08	29.29 18.67		
	4	J34 Jack-Open	6 /12	2-00-00	3-01-08	2 x 4	1-03-08 1-10-15	1-02-00 2-02-00	39.49 24.00		
	6	J38 Jack-Open	6.5 /12	3-10-08	3-03-14	2 x 4	1-03-08	1-02-11 3-03-14	73 48.00		

TOTAL # TRUSS= 62

TOTAL BFT OF ALL TRUSSES= 2211.49 BFT.

TOTAL WEIGHT OF ALL TRSSES 3516.5 LBS

HARDWARE


QTY	TYPE	MODEL	LENGTH
3	Hardware	LJS28DS	
2	Hardware	LUS24	
2	Hardware	HGUS26-2	

TOTAL NUMBER OF
ITEMS= 7

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408318	T1	1	2	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Thu Apr 23 15:32:49 2020 Page 1
ID:HJ7_mBNWkyCmBzl_hTT?DUzjdZA-aaQ1bwIbdYDpLntfcH2YKPwqzMU00ajFWp2czNp0S
20-11-13 26-8-5 30-9-0 1-3-8
Scale = 1:50.9

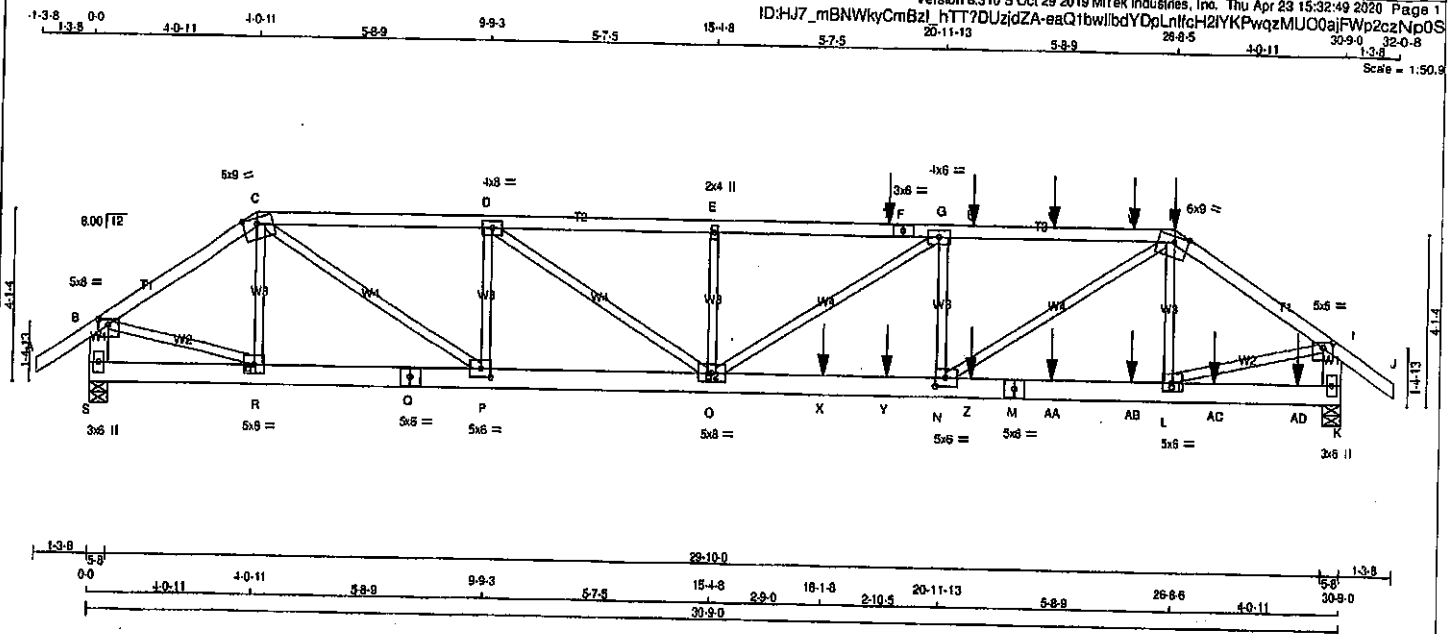

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
S - B	2x6	DRY	No.2
K - I	2x6	DRY	No.2
S - Q	2x6	DRY	1650F 1.5E
Q - M	2x6	DRY	1650F 1.5E
M - K	2x6	DRY	1650F 1.5E
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C	12	TOP
C-F	12	SIDE(0.0)
F-H	12	SIDE(61.0)
H-J	12	SIDE(61.0)
S-B	12	TOP
K-I	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
S-Q	12	TOP
Q-M	12	SIDE(0.0)
M-K	12	SIDE(0.0)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED	MAXIMUM FACTORED	INPUT	REQD	
	GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
S	2808	0	2808	0	0
K	3401	0	3401	0	0

UNFACTORED REACTIONS					
1ST CASE	MAX	MIN	COMPONENT	REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
S	1838	1234	0	0	0
K	2400	1605	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.20 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 35	-91.8 -91.8	0.07 (1)	10.00	R-D	-431 / 0	0.05 (1)
B-C	-3017 / 0	-91.8 -91.8	0.19 (1)	5.13	C-P	0 3123	0.39 (1)
C-D	-5112 / 0	-91.8 -91.8	0.40 (1)	3.98	P-D	-1778 / 0	0.23 (1)
D-E	-6993 / 0	-91.8 -91.8	0.52 (1)	3.38	D-O	0 2155	0.27 (1)
E-T	-6906 / 0	-91.8 -91.8	0.68 (1)	3.20	O-E	-461 / 0	0.06 (1)
T-F	-6906 / 0	-91.8 -91.8	0.68 (1)	3.20	O-G	0 427	0.05 (1)
F-G	-6906 / 0	-91.8 -91.8	0.68 (1)	3.20	G-H	-1129 / 0	0.14 (1)
G-U	-6550 / 0	-91.8 -91.8	0.84 (1)	3.30	H-H	0 3896	0.48 (1)
U-V	-6550 / 0	-91.8 -91.8	0.84 (1)	3.30	L-H	-765 / 0	0.10 (1)
V-W	-6550 / 0	-91.8 -91.8	0.84 (1)	3.30	B-R	0 2577	0.32 (1)
W-H	-6550 / 0	-91.8 -91.8	0.64 (1)	3.30	L-I	0 3399	0.42 (1)
H-I	-3979 / 0	-91.8 -91.8	0.22 (1)	4.57			
I-J	0 35	-91.8 -91.8	0.07 (1)	10.00			
S-B	-2592 / 0	0.0 0.0	0.09 (1)	7.81			
K-I	-3320 / 0	0.0 0.0	0.12 (1)	7.63			
S-R	0 0	-18.5 -18.5	0.03 (1)	10.00			
R-Q	0 2494	-18.5 -18.5	0.15 (1)	10.00			
Q-P	0 2494	-18.5 -18.5	0.15 (1)	10.00			
P-O	0 5112	-18.5 -18.5	0.34 (1)	10.00			
O-X	0 6550	-18.5 -18.5	0.67 (1)	10.00			
X-Y	0 6550	-18.5 -18.5	0.67 (1)	10.00			
Y-N	0 6550	-18.5 -18.5	0.67 (1)	10.00			
N-Z	0 3284	-18.5 -18.5	0.27 (1)	10.00			
Z-M	0 3284	-18.5 -18.5	0.27 (1)	10.00			
M-AA	0 3284	-18.5 -18.5	0.27 (1)	10.00			
AA-AB	0 3284	-18.5 -18.5	0.27 (1)	10.00			
AB-L	0 3284	-18.5 -18.5	0.27 (1)	10.00			
L-AC	0 0	-18.5 -18.5	0.03 (1)	10.00			
AC-AD	0 0	-18.5 -18.5	0.03 (1)	10.00			
AD-K	0 0	-18.5 -18.5	0.03 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
H	26-8-5	-50	-56	---	FRONT	VERT	DEAD	---	C1
R	26-8-5	-263	-283	---	FRONT	VERT	SNOW	---	C1
T	19-8-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	21-8-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	23-8-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	25-8-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	18-1-8	-1452	-1452	---	FRONT	VERT	TOTAL	---	C1
Y	19-8-4	-26	-28	---	FRONT	VERT	TOTAL	---	C1
Z	21-8-4	-26	-28	---	FRONT	VERT	TOTAL	---	C1

TOTAL WEIGHT = 2 X 140 = 279 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2015, ABC 2018
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TRC 2011, TRC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/970 (0.38")

CSI: TC=0.68/1.00 (E-G:1), BC=0.67/1.00 (N-O:1),
WB=0.48/1.00 (H-N:1), SS=0.28/1.00 (N-O:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRV)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667

PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (R) (INPUT = 0.80)
JSI METAL= 0.41 (R) (INPUT = 1.00)

CONTINUED ON PAGE 2



Structural component only
DWG# T-2006818

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408318	T1	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
TRUSS DESC.					

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 23 15:32:49 2020 Page 2
ID:HJ7 mBNWkyCmBzI hTT?DUZidZA-eaG1bwIbdYDpLnlfcH2IYKPwqzMUO0ajFWp2czNp0S

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.50	3.00
C	TTWW-m	MT20	6.0	9.0	1.75	4.00
D	TMVW-l	MT20	4.0	6.0		
E	TMVW-w	MT20	2.0	4.0		
F	TS-l	MT20	3.0	6.0		
G	TMVW-l	MT20	4.0	6.0		
H	TTWW-m	MT20	6.0	9.0	1.75	4.00
I	TMVW-p	MT20	5.0	6.0	1.50	3.00
K	BMV1-p	MT20	3.0	6.0		
L	BMVW-l	MT20	5.0	6.0		
M	BS-l	MT20	5.0	6.0		
N	BMVW-l	MT20	5.0	6.0	2.50	2.75
O	BMVWW-l	MT20	5.0	6.0		
P	BMVW-l	MT20	5.0	6.0	2.50	2.75
Q	BS-l	MT20	5.0	6.0		
R	BMVW-l	MT20	5.0	6.0		
S	BMV1-p	MT20	3.0	6.0		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
AA	23-8-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AB	25-8-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AC	27-8-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AD	29-8-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2006818

JOB NAME 408318	TRUSS NAME T2	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 5 Oct 29 2019 MTek Industries, Inc. Thu Apr 23 15:32:56 2020 Page 1
ID:HJ7_mBNWkyCmBzl_hTT?DUzjdZA-6m_PpGInLxg4RVMUDJohHiiYOEMHDI_jyvGMA3zNpOR

Scale = 1:50.9

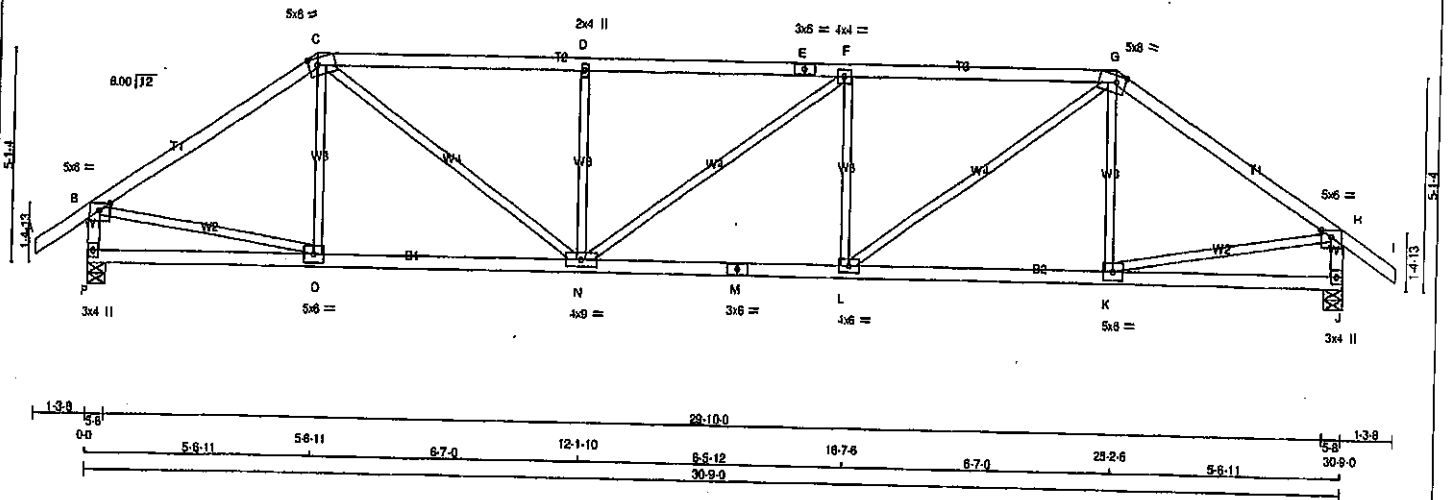

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - K	2x4	DRY	No.2
K - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2
H - F	2x4	DRY	No.2
F - D	2x4	DRY	No.2
D - B	2x4	DRY	No.2
B - A	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW-p	MT20	5.0	8.0 Edge
C	TTWW-m	MT20	5.0	8.0 2.00 2.75
D	TMVW-w	MT20	2.0	4.0
E	TS-I	MT20	3.0	8.0
F	TMVW-I	MT20	4.0	4.0
G	TTWW-m	MT20	5.0	8.0
H	TMVW-p	MT20	5.0	8.0 Edge
I	BMV1-p	MT20	3.0	4.0
J	BMVW-I	MT20	5.0	8.0
K	BMVW-I	MT20	5.0	8.0
L	BMVW-I	MT20	4.0	8.0
M	BS-I	MT20	3.0	8.0
N	BMVW-I	MT20	4.0	8.0
O	BMVW-I	MT20	5.0	8.0
P	BMV1-p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
P	1821	0	0	1821	0	5-8	5-8	5-8	5-8
J	1821	0	0	1821	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERMALIVE	WIND	DEAD	SOIL
P	1285	857 / 0	0 / 0	0 / 0	0 / 0	429 / 0	0 / 0
J	1285	857 / 0	0 / 0	0 / 0	0 / 0	429 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.42 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		FACTORED		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	FROM TO	MAX. CS (LC)	UNBRAC. LENGTH	MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	FROM TO	MAX. CS (LC)	UNBRAC. LENGTH
FR-TO						FR-TO					
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	O-C	-184 / 33	0.07 (1)			
B-C	-1958 / 0	-91.8	-91.8	0.65 (1)	4.09	C-N	0 / 1302	0.29 (1)			
C-D	-2675 / 0	-91.8	-91.8	0.80 (1)	3.43	N-D	-850 / 0	0.25 (1)			
D-E	-2676 / 0	-91.8	-91.8	0.80 (1)	3.42	N-F	-2 / 0	0.00 (1)			
E-F	-2676 / 0	-91.8	-91.8	0.80 (1)	3.42	L-F	-650 / 0	0.25 (1)			
F-G	-2677 / 0	-91.8	-91.8	0.81 (1)	3.42	L-G	0 / 1304	0.29 (1)			
G-H	-1958 / 0	-91.8	-91.8	0.85 (1)	4.09	K-G	-185 / 33	0.07 (1)			
H-I	0 / 35	-91.8	-91.8	0.12 (1)	10.00	B-O	0 / 1657	0.37 (1)			
P-B	-1780 / 0	0.0	0.0	0.18 (1)	8.28	K-H	0 / 1658	0.37 (1)			
J-H	-1780 / 0	0.0	0.0	0.18 (1)	8.28						
P-O	0 / 0	-18.5	-18.5	0.16 (4)	10.00						
O-N	0 / 1623	-18.5	-18.5	0.35 (1)	10.00						
N-M	0 / 2677	-18.5	-18.5	0.50 (1)	10.00						
M-L	0 / 2677	-18.5	-18.5	0.50 (1)	10.00						
L-K	0 / 1623	-18.5	-18.5	0.35 (1)	10.00						
K-J	0 / 0	-18.5	-18.5	0.16 (4)	10.00						

TOTAL WEIGHT = 121 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(85% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/960 (1.03")
CALCULATED VERT. DEFL. (LL) = L/999 (0.13")
ALLOWABLE DEFL. (TL) = L/980 (1.03")
CALCULATED VERT. DEFL. (TL) = L/999 (0.26")

CS: TC=0.81/1.00 (F-G:1), BC=0.50/1.00 (L-N:1), WB=0.37/1.00 (B-C:1), SS=0.28/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (Q) (INPUT = 0.90)
JSI METAL = 0.87 (M) (INPUT = 1.00)



Structural component only
DWG# T-2006819

JOB NAME 408318	TRUSS NAME T2X	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

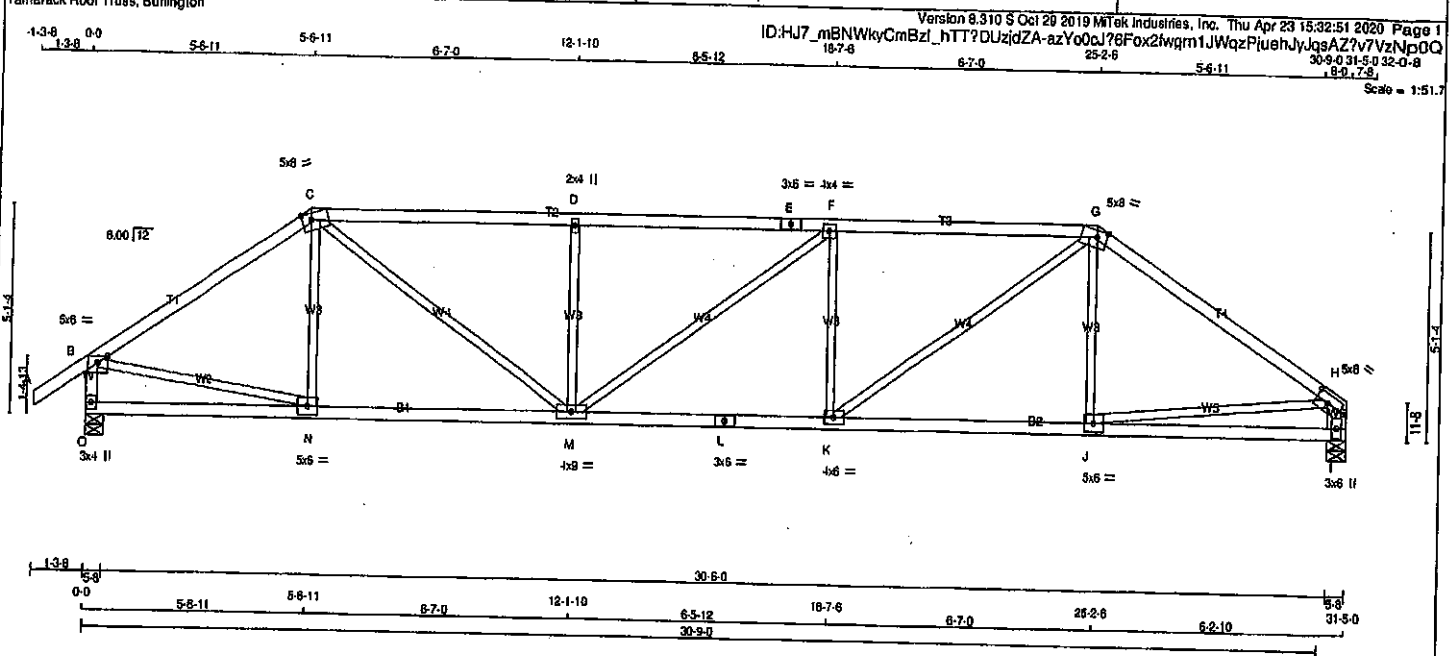

LUMBER			
N.L.G.A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
O - B	2x4	DRY	No.2
O - L	2x4	DRY	No.2
L - I	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
I - H	2x6	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	X
B	TMWV-p	MT20	5.0	6.0	Edge
C	TTWW-m	MT20	5.0	8.0	2.00 2.75
D	TMW-w	MT20	2.0	4.0	
E	TS-1	MT20	3.0	6.0	
F	TMWW-1	MT20	4.0	4.0	
G	TTWW-m	MT20	5.0	8.0	2.00 3.00
H	TMWW-1	MT20	5.0	8.0	2.50 3.75
I	BMW1-w	MT20	3.0	6.0	
J	BMWW-1	MT20	5.0	8.0	
K	BMWW-1	MT20	4.0	6.0	
L	BS-1	MT20	3.0	6.0	
M	BMWW-1	MT20	4.0	9.0	
N	BMWW-1	MT20	5.0	8.0	
O	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	DOWN	UP	IN-SX
O	1845 0	1845 0	0 0	5-8	5-8
I	1719 0	1719 0	0 0	5-8	5-8

UNFACTORED REACTIONS		1ST LCASE	MAX. MIN. COMPONENT REACTIONS	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
O	1303	888 0	0 0	0 0	434 0
I	1216	798 0	0 0	0 0	418 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, I

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.38 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC	MEMB.	FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO	LENGTH	FR-TO		
A-B	0 35	-91.8	-91.8 0.12 (1)	10.00	N-C	-189 31	0.07 (1)
B-C	-1992 0	-91.8	-91.8 0.65 (1)	4.05	C-M	0 1343	0.30 (1)
C-D	-2736 0	-91.8	-91.8 0.81 (1)	3.39	M-D	-650 0	0.25 (1)
D-E	-2736 0	-91.8	-91.8 0.81 (1)	3.38	M-F	-42 0	0.06 (1)
E-F	-2736 0	-91.8	-91.8 0.81 (1)	3.38	K-F	-628 0	0.24 (1)
F-G	-2770 0	-91.8	-91.8 0.83 (1)	3.38	K-G	0 1261	0.22 (1)
G-H	-2109 0	-91.8	-91.8 0.81 (1)	3.77	J-G	-88 69	0.04 (1)
O-B	-1804 0	0.0	0.0 0.19 (1)	6.23	B-N	0 1685	0.38 (1)
					J-H	0 1767	0.40 (1)
O-N	0 0	-18.5	-18.5 0.16 (4)	10.00	I-H	-1674 0	0.11 (1)
N-M	0 1851	-18.5	-18.5 0.35 (1)	10.00			
M-L	0 2770	-18.5	-18.5 0.51 (1)	10.00			
L-K	0 2770	-18.5	-18.5 0.51 (1)	10.00			
K-J	0 1751	-18.5	-18.5 0.38 (1)	10.00			
J-I	0 0	-18.5	-18.5 0.17 (4)	10.00			

TOTAL WEIGHT = 121 lb

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPC 2011, TPC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (1.04")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.14")
ALLOWABLE DEFL. (TL) = $L/360$ (1.04")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.28")

CSI: TC=0.83/1.00 (F-G:1), BC=0.51/1.00 (K-M:1), WB=0.40/1.00 (H-J:1), SB=0.28/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MT20	618	354	1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.90 (C) (INPUT = 0.90)
JSI METAL = 0.90 (L) (INPUT = 1.00)



Structural component only
DWG# T-2008820

DRWG NO.

Version 8.310 S Oct 29 2019 MTX Industries, Inc. Thu Apr 23 15:32:53 2020 Page 1

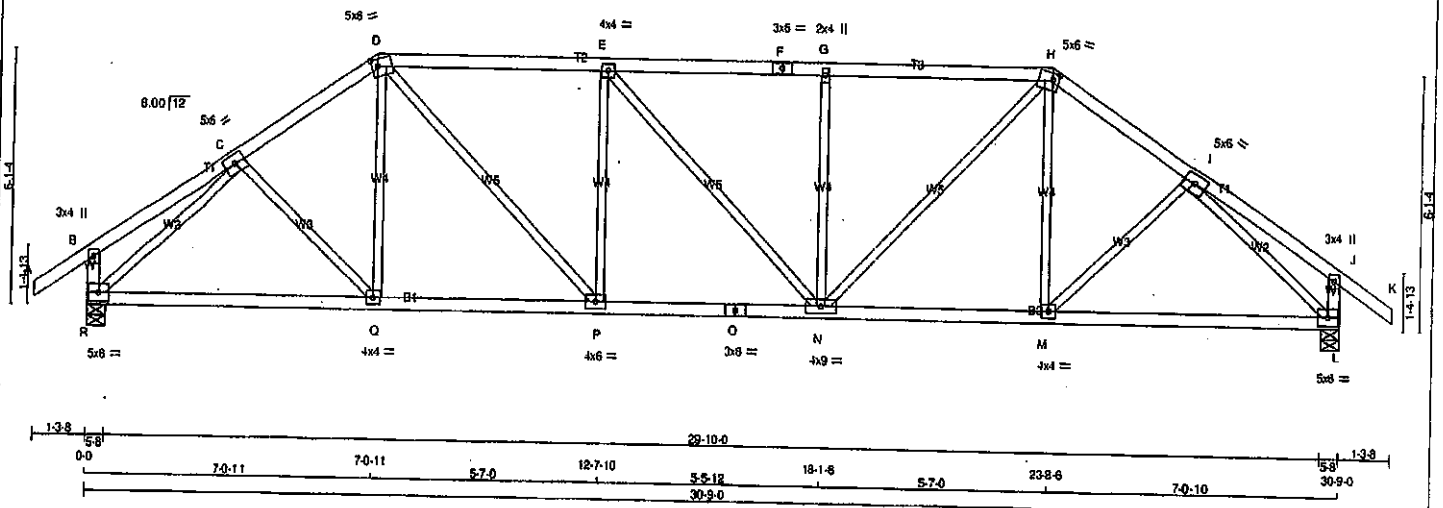

TOTAL WEIGHT = 2 X 131 = 262 lb

LUMBER			
N. L. G. A. RULES			
CHORDS		SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
R - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT
DRY: SEASONED LUMBER.

LATES (tablets in inches)					
TYPE	PLATES	W	LEN	Y	X
TMW+p	MT20	3.0	4.0		
TMWV-1	MT20	5.0	6.0		
TTWV-m	MT20	5.0	8.0	2.00	1.75
TMWV-1	MT20	4.0	4.0		
TS-1	MT20	3.0	6.0		
TMW+wy	MT20	2.0	4.0		
TTWV-m	MT20	5.0	8.0	2.00	1.75
TMWV-1	MT20	5.0	8.0		
TMV+P	MT20	3.0	4.0		
BMWV1-1	MT20	5.0	8.0		
BMWV-1	MT20	4.0	4.0		
BMWVW-1	MT20	4.0	9.0		
BS-1	MT20	3.0	6.0		
BMWV-1	MT20	4.0	6.0		
BMWV-1	MT20	4.0	4.0		
BMWV1-1	MT20	5.0	8.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
R	1821	0	1821	0	0	5-8	5-8
L	1821	0	1821	0	0	5-8	5-8

UNFACTORED REACTIONS							
JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	1285	857.0	0.0	0.0	0.0	429.0	0.0
L	1285	857.0	0.0	0.0	0.0	429.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.08 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED			WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM	TO		FR-TO			
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	Q-C	0 / 71	0.02 (4)
B-C	0 / 18	-91.8	-91.8	0.16 (1)	10.00	C-D	0 / 106	0.04 (4)
C-D	-1949 / 0	-91.8	-91.8	0.22 (1)	4.83	D-P	0 / 892	0.20 (1)
D-E	-2223 / 0	-91.8	-91.8	0.50 (1)	4.08	P-E	-549 / 0	0.32 (1)
E-F	-2221 / 0	-91.8	-91.8	0.59 (1)	4.08	E-N	-2 / 0	0.00 (1)
F-G	-2221 / 0	-91.8	-91.8	0.50 (1)	4.08	N-H	-549 / 0	0.32 (1)
G-H	-2221 / 0	-91.8	-91.8	0.50 (1)	4.07	N-H	0 / 889	0.20 (1)
H-I	-1949 / 0	-91.8	-91.8	0.22 (1)	4.83	M-H	0 / 106	0.04 (4)
I-J	0 / 18	-91.8	-91.8	0.16 (1)	10.00	M-I	0 / 71	0.02 (4)
J-K	0 / 35	-91.8	-91.8	0.12 (1)	10.00	R-C	-2167 / 0	0.83 (1)
R-B	-254 / 0	0.0	0.0	0.03 (1)	7.81	I-L	-2168 / 0	0.83 (1)
L-J	-254 / 0	0.0	0.0	0.03 (1)	7.81			
FR-Q	0 / 1553	-18.5	-18.5	0.36 (1)	10.00			
Q-P	0 / 1805	-18.5	-18.5	0.37 (1)	10.00			
P-O	0 / 2223	-18.5	-18.5	0.41 (1)	10.00			
O-N	0 / 2223	-18.5	-18.5	0.41 (1)	10.00			
N-M	0 / 1805	-18.5	-18.5	0.37 (1)	10.00			
M-L	0 / 1553	-18.5	-18.5	0.36 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:					
TOP	CH.	LL	=	25.8	PSF
		DL	=	6.0	PSF
BOT	CH.	LL	=	0.0	PSF
		DL	=	7.4	PSF
TOTAL LOAD				=	39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.02")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL)= L/360 (1.02")
CALCULATED VERT. DEFL.(TL) = L/999 (0.20")

CSI: TC=0.50/1.00 (D-E:1), BC=0.41/1.00 (N-P:1),
WB=0.63/1.00 (I-L:1), SSI=0.24/1.00 (O-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP (DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	818	354	1667	788	1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (L) (INPUT = 0.90)
JSI METAL= 0.73 (O) (INPUT = 1.00)




Structural component only
DWG# T-2006821

Tamarack Roof Truss, Burrington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 23 15:32:54 2020 Page 1
ID:HJ7_mBNWkyCmBzl_hTT?DUzjdZA-?XDwteLiPAAWv6lFS9sDSb1HDrik9GHjXEkqzNpOo

-1-3-8 0-0 +1-9 +1-9 6-5-11 6-9-14 15-4-8 6-9-14 22-2-6 4-2-1 28-4-7 4-1-9 30-9-0 32-0-6 1-3-8

Scale = 1/50

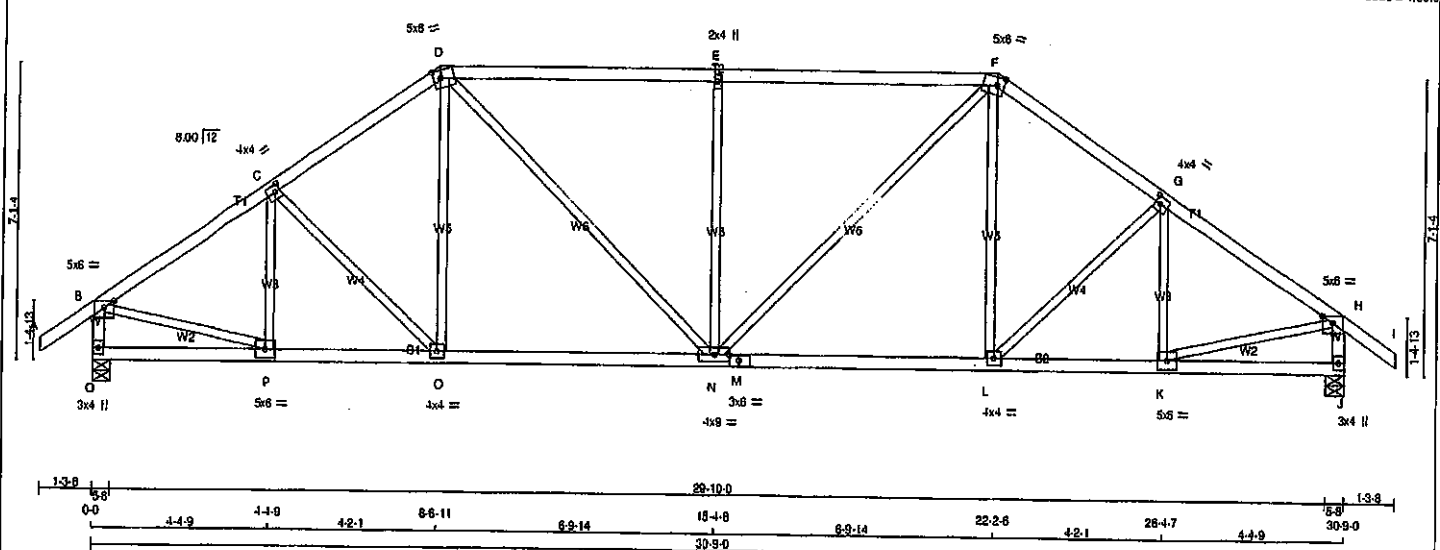

LUMBER				
N. L. G. A. RULES				
CHORDS		SIZE	LUMBER	DESCR
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
Q - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
Q - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
DRY; SEASONED LUMBER.				

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMWW-p	MT20	5.0	6.0	Edge
C	TMWW-t	MT20	4.0	4.0	2.00 1.50
D	TTWW-m	MT20	5.0	8.0	2.25 2.00
E	TMW-w	MT20	2.0	4.0	
F	TTWW-m	MT20	5.0	6.0	2.25 2.00
G	TMWW-p	MT20	4.0	4.0	2.00 1.50
H	TMWW-p	MT20	5.0	6.0	Edge
J	BMV-t	MT20	3.0	4.0	
K	BMWW-t	MT20	5.0	6.0	
L	BMWW-t	MT20	4.0	4.0	
M	GS-t	MT20	3.0	8.0	1.50 2.75
N	BMWWW-t	MT20	4.0	9.0	
O	BMWW-t	MT20	4.0	4.0	
P	BMWW-t	MT20	5.0	6.0	
C	BMV-t	MT20	2.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
<u>BEARINGS</u>							
JT Q	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SK	IN-SK
1	1821	0	1821	0	0	5-8	5-8
2	1821	0	1821	0	0	5-8	5-8

UNFACTORED REACTIONS							
1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
Q	1285	857.0	0.0	0.0	0.0	429.0	0.0
J	1285	857.0	0.0	0.0	0.0	429.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.03 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LOAD C1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)		
FR-TO		FROM	TO		FR-TO				
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	P-C	-332 / 0	0.09 (1)	
B-C	-1950 / 0	-91.8	-91.8	0.26 (1)	4.60	C-D	-133 / 0	0.08 (1)	
C-D	-1886 / 0	-91.8	-91.8	0.25 (1)	4.87	C-D	0 / 201	0.05 (4)	
D-E	-1929 / 0	-91.8	-91.8	0.83 (1)	4.03	D-N	0 / 835	0.14 (1)	
E-F	-1993 / 0	-91.8	-91.8	0.93 (1)	4.03	N-E	-769 / 0	0.87 (1)	
F-G	-1888 / 0	-91.8	-91.8	0.25 (1)	4.67	N-F	0 / 835	0.15 (4)	
G-H	-1950 / 0	-91.8	-91.8	0.26 (1)	4.60	L-G	-133 / 0	0.08 (1)	
H-I	0 / 35	-91.8	-91.8	0.12 (1)	10.00	K-G	-332 / 0	0.09 (1)	
I-J	-1783 / 0	0.0	0.0	0.18 (1)	6.26	K-G	0 / 1692	0.39 (1)	
J-B	-1783 / 0	0.0	0.0	0.18 (1)	6.26	B-K	0 / 1692	0.38 (1)	
Q-P	0 / 0	-18.5	-18.5	0.08 (4)	10.00				
P-O	0 / 1643	-18.5	-18.5	0.34 (1)	10.00				
O-N	0 / 1549	-18.5	-18.5	0.34 (1)	10.00				
N-M	0 / 1549	-18.5	-18.5	0.34 (1)	10.00				
M-L	0 / 1549	-18.5	-18.5	0.34 (1)	10.00				
L-K	0 / 1643	-18.5	-18.5	0.34 (1)	10.00				
K-J	0 / 0	-18.5	-18.5	0.08 (4)	10.00				

TOTAL WEIGHT = 2 X 133 = 266 lb

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL	=	25.8 PSF
	DL	=	8.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.4 PSF
TOTAL LOAD		=	39.0 PSF

SPACING is 24.0 N.C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2015
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 0.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.03")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.08")
ALLOWABLE DEFL.(TL) = $L/360$ (1.03")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.16")

CSI: TC=0.83/1.00 (D-E:1), BC=0.34/1.00 (L-N:1)
WB=0.67/1.00 (E-N:1), SSI=0.30/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
PLATE	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.



JSI GRIP= 0.88 (B) (INPUT = 0.80)
JSI METAL= 0.52 (M) (INPUT = 1.00



Structural component only
DWG# T-2006822


DRWG NO.

1-3.9 0-0 5-1.9 5-1.9 10-0.11 15-4.8 20-8.6 25-7.7 30-9.0 32-0.8



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408318	T5X	6	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 9 Oct 29 2019 MTEK Industries, Inc. Thu Apr 23 15:32:57 2020 Page 1
 ID:HJ7_mBNWkyCmBzl_hTT?DUzjdZA-P6v3HgOm5Y4maQq7HQw4EfrZ3nMMxmIzVSEK9zNo0K
 30-9.0 31.5 32-0.8
 1.89 1.78
 Scale = 1:51.7

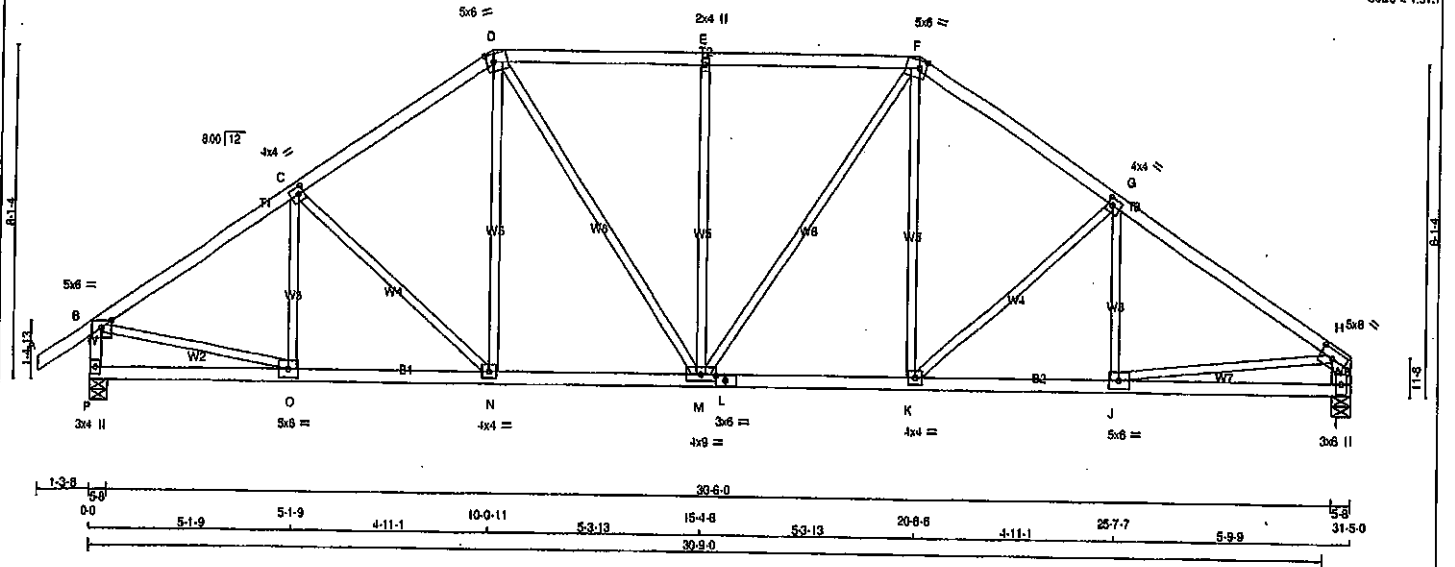

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
P - B	2x4	DRY	No.2
P - L	2x4	DRY	No.2
L - I	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
I - H	2x6	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW-p	MT20	5.0	6.0 Edge
C	TMVW-1	MT20	4.0	4.0 2.00 1.50
D	TTWW-m	MT20	5.0	6.0 2.25 2.00
E	TMVW-w	MT20	2.0	4.0
F	TTWW-m	MT20	5.0	6.0 2.25 2.00
G	TMVW-1	MT20	4.0	4.0 2.00 1.50
H	TMVW-1	MT20	5.0	8.0 2.50 3.75
I	BMVW-1	MT20	3.0	6.0
J	BMVW-1	MT20	5.0	6.0
K	BMVW-1	MT20	4.0	4.0
L	BS-1	MT20	3.0	6.0 1.50 2.75
M	BMVW-1	MT20	4.0	9.0
N	BMVW-1	MT20	4.0	4.0
O	BMVW-1	MT20	5.0	6.0
P	BMVW-1	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	HORZ	BRG	IN-SX	BRG	IN-SX
P	1845	0	1845	0	0	5-8	5-8	5-8	5-8
I	1719	0	1719	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST LCASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERMALIVE	WIND
P	1303	888 / 0	0 / 0	0 / 0	0 / 0
I	1216	798 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.24 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)		CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC) (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO		FR-TO	
A-B	0 / 35	-91.8 -91.8 0.12 (1)	10.00	C-C	-260 / 0
B-C	-2020 / 0	-91.8 -91.8 0.36 (1)	4.43	C-N	-270 / 0
C-D	-1841 / 0	-91.8 -91.8 0.34 (1)	4.61	D-M	0 / 277
D-E	-1760 / 0	-91.8 -91.8 0.37 (1)	4.64	D-M	0 / 447
E-F	-1760 / 0	-91.8 -91.8 0.37 (1)	4.64	M-E	-595 / 0
F-G	-1882 / 0	-91.8 -91.8 0.38 (1)	4.52	M-F	0 / 389
G-H	-2160 / 0	-91.8 -91.8 0.43 (1)	4.24	K-F	0 / 352
P-B	-1804 / 0	0.0 0.0 0.19 (1)	6.23	K-G	-384 / 0
				J-G	-154 / 36
P-O	0 / 0	-18.5 -18.5 0.10 (4)	10.00	B-O	0 / 1743
O-N	0 / 1705	-18.5 -18.5 0.33 (1)	10.00	J-H	0 / 1840
N-M	0 / 1508	-18.5 -18.5 0.30 (1)	10.00	I-H	-1674 / 0
M-L	0 / 1541	-18.5 -18.5 0.30 (1)	10.00		
L-K	0 / 1541	-18.5 -18.5 0.30 (1)	10.00		
K-J	0 / 1622	-18.5 -18.5 0.34 (1)	10.00		
J-I	0 / 0	-18.5 -18.5 0.12 (4)	10.00		

TOTAL WEIGHT = 6 X 140 = 837 lb

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, ORC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.04")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
 ALLOWABLE DEFL.(TL) = L/360 (1.04")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.15")

CSI: TC=0.43/1.00 (G-H-1), BC=0.34/1.00 (J-K-1), WB=0.75/1.00 (E-M-1), SS=0.24/1.00 (E-F-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP(DRY) SHEAR	SECTION	(PSI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	818	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.89 (B) (INPUT = 0.90)
 JSI METAL= 0.46 (L) (INPUT = 1.00)

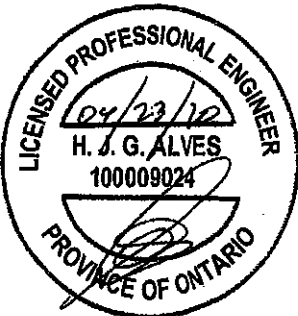

Structural component only
 DWG# T-2006824

JOB NAME 408318	TRUSS NAME T7X	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

ID: HJ7_mBNWkyCmBzL_HTT7DUZkdZA-QFIU8V2xHhyCOncpISYnI9DUuVVjVw6BABwogPzNlWw
Version 8.910 S Oct 29 2019 MTek Industries, Inc. Thu Apr 23 20:17:33 2020 Page 1
15-4-8 15-2-12 18-2-12 20-11-13 5-9-9 26-8-8 4-8-10 31-5-0
1-3-8 0-0 4-0-11 4-0-11 5-9-9 9-9-3 5-7-5 15-4-8 15-2-12 18-2-12 20-11-13 5-9-9 26-8-8 4-8-10 31-5-0
Scale = 1:50.3

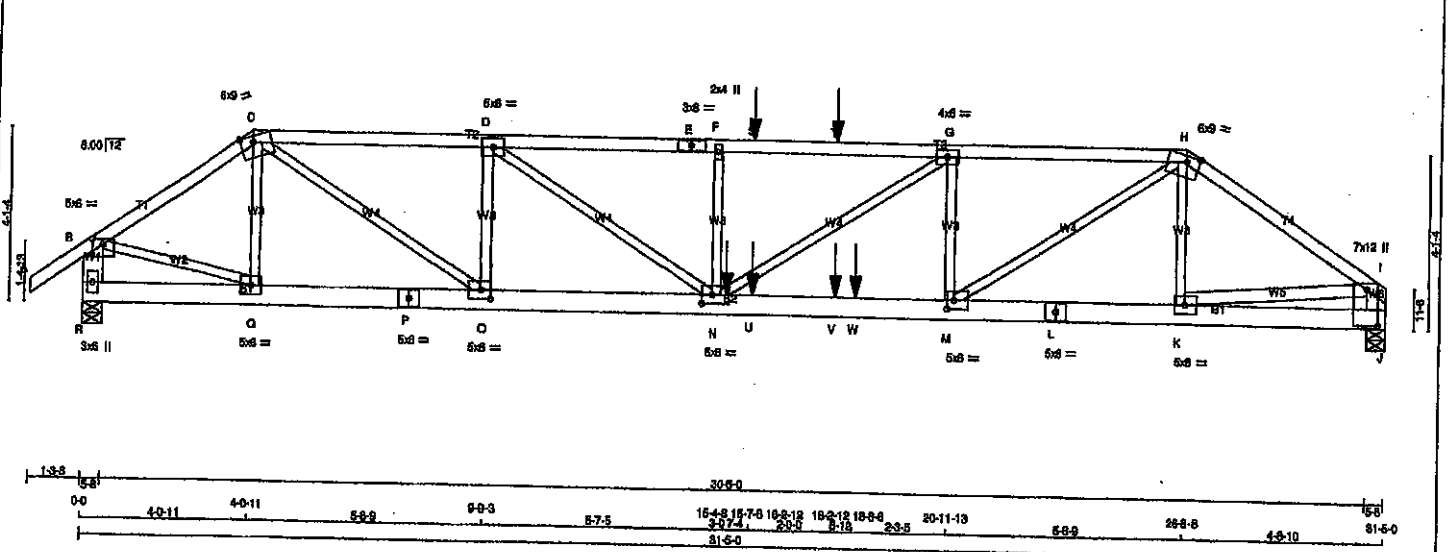

CHORDS	SIZE	DRY	NO.2	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - H	2x4	DRY	No.2	SPF
H - I	2x4	DRY	No.2	SPF
R - B	2x6	DRY	No.2	SPF
J - I	2x6	DRY	No.2	SPF
R - P	2x6	DRY	1850F 1.5E	SPF
P - L	2x6	DRY	1850F 1.5E	SPF
L - J	2x6	DRY	1850F 1.5E	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
K - I	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.


DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122'X3') SPIRAL NAILS		
A - C	12	TOP
C - E	12	TOP
E - H	12	TOP
H - I	12	TOP
R - B	12	TOP
J - I	12	TOP
BOTTOM CHORDS : (0.122'X3') SPIRAL NAILS		
R - P	12	TOP
P - L	12	TOP
L - J	12	TOP
WEBS : (0.122'X3') SPIRAL NAILS		
F - N	8	TOP
2x3	8	TOP
2x4	8	TOP

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

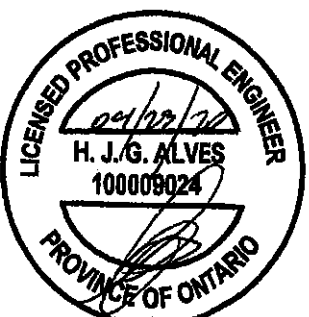

Structural component only
DWG# T-2008826

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT VERT	3341	0	0
R VERT	3341	0	0
J HORIZ	3442	0	0
R HORIZ	3442	0	0

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS	DEAD	SOIL
JT COMBINED	2358	1588 / 0	0 / 0
R COMBINED	2428	1828 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORZ. LOAD (LBS)
FR-TO	A-B	0 / 35	-91.8	-91.8	0.07 (1)	10.00	Q-C	-634 / 0	0.08 (1)
	B-C	-3889 / 0	-91.8	-91.8	0.22 (1)	4.67	C-D	0 / 4469	0.55 (1)
	C-D	-7042 / 0	-91.8	-91.8	0.52 (1)	3.98	D-E	-2441 / 0	0.31 (1)
	D-E	-9871 / 0	-91.8	-91.8	0.79 (1)	2.68	E-F	0 / 3397	0.42 (1)
	E-F	-9871 / 0	-91.8	-91.8	0.79 (1)	2.68	F-G	0 / 1948	0.24 (1)
	F-G	-9871 / 0	-91.8	-91.8	0.86 (1)	2.58	G-H	-1732 / 0	0.22 (1)
	G-H	-9871 / 0	-91.8	-91.8	0.86 (1)	2.58	H-I	0 / 5042	0.52 (1)
	H-I	-9871 / 0	-91.8	-91.8	0.86 (1)	2.58	I-J	-487 / 0	0.08 (1)
	I-J	-3327 / 0	0.0	0.0	0.12 (1)	7.62	J-K	0 / 3407	0.42 (1)
	J-K	-3381 / 0	0.0	0.0	0.12 (1)	7.68	K-L	0 / 4061	0.36 (1)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)
FR-TO	Q-P	0 / 0	-18.5	-18.5	0.03 (4)
	P-O	0 / 3285	-18.5	-18.5	0.17 (1)
	O-N	0 / 3285	-18.5	-18.5	0.17 (1)
	N-U	0 / 7042	-18.5	-18.5	0.34 (1)
	U-V	0 / 8248	-18.5	-18.5	0.69 (1)
	V-W	0 / 8248	-18.5	-18.5	0.69 (1)
	W-M	0 / 8248	-18.5	-18.5	0.69 (1)
	M-L	0 / 4021	-18.5	-18.5	0.29 (1)
	L-K	0 / 4021	-18.5	-18.5	0.29 (1)
	K-J	0 / 0	-18.5	-18.5	0.03 (1)

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LOC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
	N	15-7-8	-1680	-1680	---	BACK	VERT	TOTAL	---	C1
	S	15-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
	T	15-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
	U	15-2-12	-25	-25	---	BACK	VERT	TOTAL	---	C1
	V	15-2-12	-25	-25	---	BACK	VERT	TOTAL	---	C1
	W	15-9-8	-1240	-1240	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 141 = 282 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 33.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(68 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.05')
CALCULATED VERT. DEFL. (LL) = 1/999 (0.27')
ALLOWABLE DEFL. (TL) = L/360 (1.05')
CALCULATED VERT. DEFL. (TL) = 1/763 (0.49')

CSK TO = 0.88/1.0 (F-G:1), BC = 0.69/1.0 (M-N:1), WB = 0.62/1.0 (H-M:1), SS = 0.29/1.0 (M-N:1)

DOL LUMBER = 1.00 NAIL = 1.00 LB BEND = 1.00 COMP = 1.00 SHEAR = 1.00 TENS = 1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.80 (O) (INPUT = 0.90)
JSI METAL = 0.63 (M) (INPUT = 1.00)

JOB NAME 408318	TRUSS NAME T7X	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.510 S Oct 29 2019 MITek Industries, Inc. Thu Apr 23 20:17:34 2020 Page 2
 ID:HJ7 mBNWlGmBzl hTT7DUz9ZA-uSGInu2727430xOu0GIXGR3h381MMKPmMCzNkrV


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	6.0	6.0	1.50	3.00
C	TTWW-m	MT20	6.0	9.0	1.75	3.75
D	TMWW-t	MT20	6.0	6.0		
E	TS-t	MT20	3.0	6.0		
F	TMW-w	MT20	2.0	4.0		
G	TMWW-t	MT20	4.0	6.0		
H	TTWW-m	MT20	6.0	9.0	1.75	3.25
I	TMBMWV1*-p	MT20	7.0	12.0	10.00	3.25
K	BMWW-t	MT20	5.0	6.0		
L	BS-t	MT20	5.0	6.0		
M	BMWW-t	MT20	5.0	6.0	2.50	2.00
N	BMWWV-t	MT20	5.0	6.0	2.50	3.00
O	BMWW-t	MT20	5.0	6.0	2.50	2.50
P	BS-t	MT20	5.0	6.0		
Q	BMWW-t	MT20	5.0	6.0		
R	BMV1-p	MT20	3.0	6.0		



Structural component only
 DWG# T-2006826 *2/2*

JOB NAME 408318	TRUSS NAME T8	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 23 15:33:00 2020 Page 1	

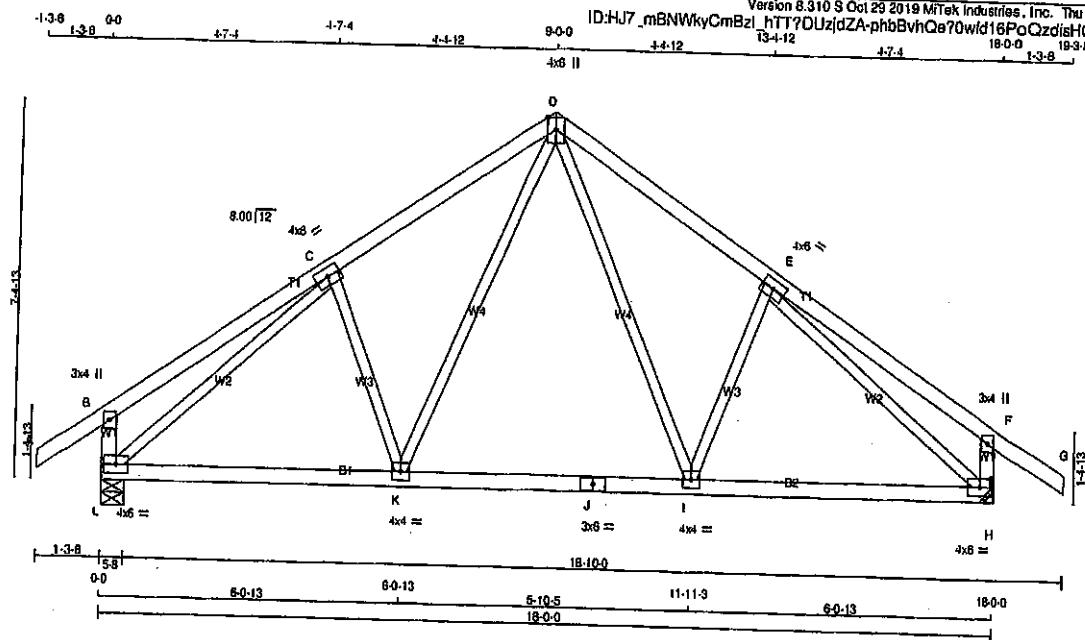

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
L - B	2x4	DRY	No.2
L - F	2x4	DRY	No.2
L - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)			
JT	TYPE	PLATES	W LEN Y X
B	TMV+p	MT20	3.0 4.0
C	TMVW+1	MT20	4.0 8.0
D	TTWW+p	MT20	4.0 8.0
E	TMVW+1	MT20	4.0 8.0
F	TMV+p	MT20	3.0 4.0
H	BMVW+1	MT20	4.0 8.0
I	BMVW+1	MT20	4.0 8.0
J	BS+1	MT20	3.0 8.0
K	BMVW+1	MT20	4.0 8.0
L	BMVW+1	MT20	4.0 8.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
L	1118	0	1118	0	5-8
H	1118	0	1118	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
L	788	531.0	0.0	0.0	0.0	258.0	0.0
H	788	531.0	0.0	0.0	0.0	258.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.05 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0.35	-91.8	-91.8 0.12 (1)	D-I	0.387	0.09 (1)	
B-C	0.27	-91.8	-91.8 0.30 (1)	I-E	-255.0	0.08 (1)	
C-D	-959.0	-91.8	-91.8 0.24 (1)	K-D	0.387	0.09 (1)	
D-E	-959.0	-91.8	-91.8 0.24 (1)	C-K	-255.0	0.08 (1)	
E-F	0.27	-91.8	-91.8 0.30 (1)	L-C	-1174.0	0.73 (1)	
F-G	0.35	-91.8	-91.8 0.12 (1)	E-H	-1174.0	0.73 (1)	
L-B	-283.0	0.0	0.0 0.03 (1)				
H-F	-283.0	0.0	0.0 0.03 (1)				
L-K	0.889	-18.5	-18.5 0.22 (4)				
K-J	0.828	-18.5	-18.5 0.20 (4)				
J-I	0.828	-18.5	-18.5 0.20 (4)				
I-H	0.889	-18.5	-18.5 0.22 (4)				

TOTAL WEIGHT = 2 X 79 = 159 lb [M/F]

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAW LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.60")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.60")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.03")

CSI: TC=0.30/1.00 (B-C:1), BC=0.22/1.00 (K-L:4), WB=0.73/1.00 (C-L:1), SS=0.17/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1668

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.82 (E) (INPUT = 0.90)
JSI METAL= 0.30 (C) (INPUT = 1.00)



Structural component only
DWG# T-2006827

JOB NAME 408318	TRUSS NAME T8G	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

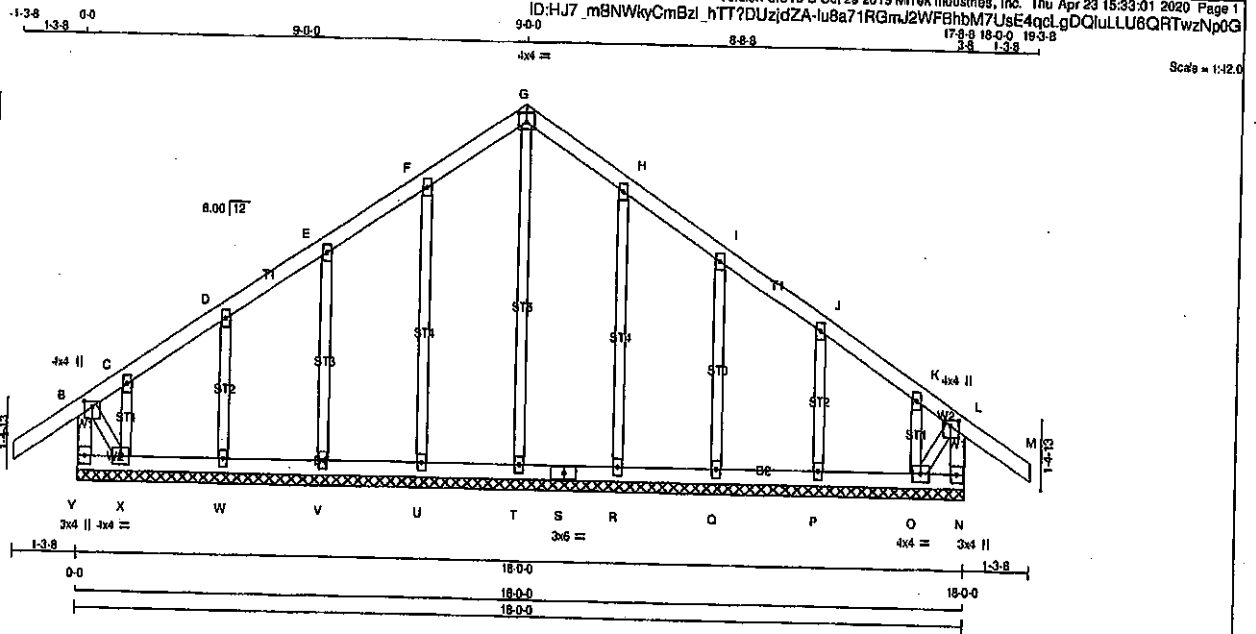

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
Y - B	2x4	DRY	No.2
A - G	2x4	DRY	No.2
G - M	2x4	DRY	No.2
N - L	2x4	DRY	No.2
Y - S	2x4	DRY	No.2
S - N	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2'-0" O.C.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
C, D, E, F, H, I, J, K						
C	TMW+w	MT20	2.0	4.0		
G	TTW-p	MT20	4.0	4.0	2.25	2.00
L	TMVW+p	MT20	4.0	4.0	1.25	2.00
N	BMV1+p	MT20	3.0	4.0		
O	BMVW1-i	MT20	4.0	4.0		
P, Q, R, T, U, V, W						
P	BMV1+w	MT20	2.0	4.0		
S	BS-i	MT20	3.0	8.0		
X	BMVW1-i	MT20	4.0	4.0		
Y	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED (CSI (LC))	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED (CSI (LC))	
FR-TO		FROM TO		FR-TO			
Y-B	-282 / 0	0.0	0.0 0.03 (1)	T-G	-145 / 0	0.14 (1)	
A-B	0 / 35	-91.8	-91.8 0.12 (1)	U-F	-208 / 0	0.12 (1)	
B-C	68 / 0	-91.8	-91.8 0.12 (1)	V-E	-173 / 0	0.06 (1)	
C-D	-15 / 0	-91.8	-91.8 0.05 (1)	W-D	-194 / 0	0.04 (1)	
D-E	-16 / 0	-91.8	-91.8 0.05 (1)	X-C	-41 / 0	0.01 (1)	
E-F	-8 / 0	-91.8	-91.8 0.05 (1)	R-H	-209 / 0	0.12 (1)	
F-G	-18 / 0	-91.8	-91.8 0.05 (1)	Q-I	-173 / 0	0.06 (1)	
G-H	-18 / 0	-91.8	-91.8 0.05 (1)	P-J	-194 / 0	0.04 (1)	
H-I	-8 / 0	-91.8	-91.8 0.05 (1)	O-K	-41 / 0	0.01 (1)	
I-J	-15 / 0	-91.8	-91.8 0.05 (1)	B-X	0 / 28	0.01 (1)	
K-L	-68 / 0	-91.8	-91.8 0.12 (1)	O-L	0 / 28	0.01 (1)	
L-M	0 / 35	-91.8	-91.8 0.12 (1)				
N-L	-282 / 0	0.0	0.0 0.03 (1)				
Y-X	0 / 0	-18.5	-18.5 0.01 (4)				
X-W	0 / 17	-18.5	-18.5 0.02 (4)				
W-V	0 / 12	-18.5	-18.5 0.02 (4)				
V-U	0 / 9	-18.5	-18.5 0.01 (4)				
U-T	0 / 6	-18.5	-18.5 0.01 (4)				
T-S	0 / 6	-18.5	-18.5 0.01 (4)				
S-R	0 / 6	-18.5	-18.5 0.01 (4)				
R-Q	0 / 9	-18.5	-18.5 0.01 (4)				
Q-P	0 / 12	-18.5	-18.5 0.02 (4)				
P-O	0 / 17	-18.5	-18.5 0.02 (4)				
O-N	0 / 0	-18.5	-18.5 0.01 (4)				

TOTAL WEIGHT = 81 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (L-M:1), BC=0.02/1.00 (O-P:4), WB=0.14/1.00 (G-T:1), SSI=0.08/1.00 (L-M:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.48 (X) (INPUT = 0.90)
JSI METAL = 0.11 (F) (INPUT = 1.00)



Structural component only
DWG# T-2006828

JOB NAME 408318	TRUSS NAME T9	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

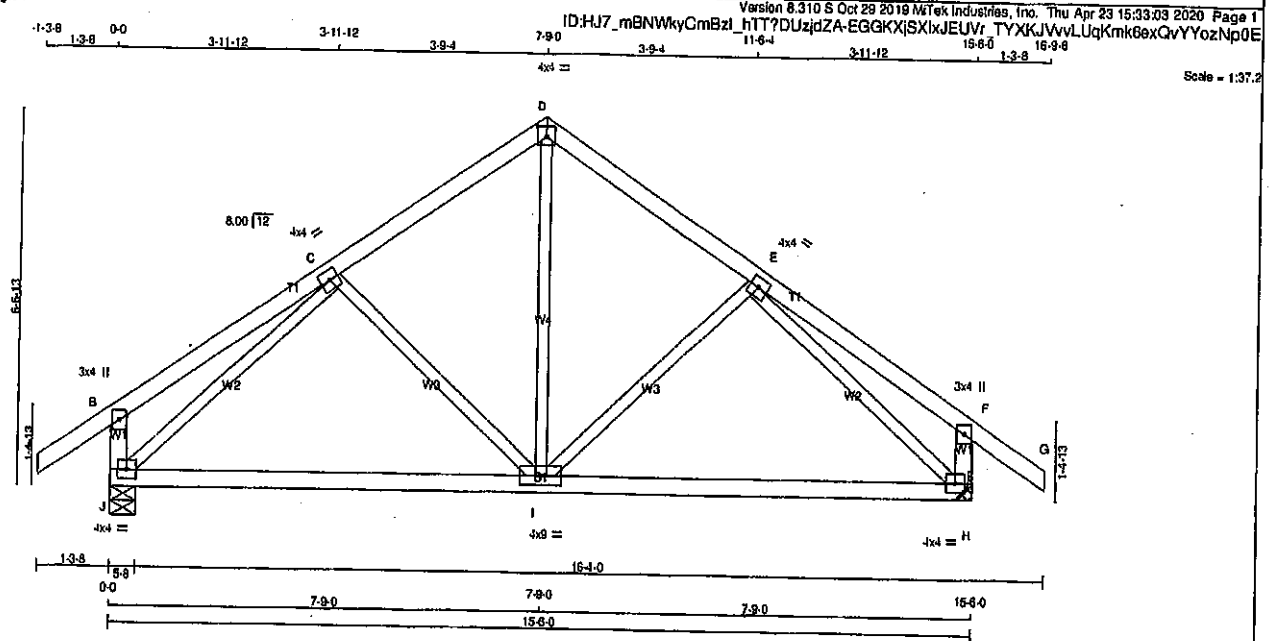

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
J - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
C	TMVW-1	MT20	4.0	4.0
D	TTW-p	MT20	4.0	4.0 2.25 2.00
E	TMVW-1	MT20	4.0	4.0
F	TMV+p	MT20	3.0	4.0
H	BMVW-1	MT20	4.0	4.0
I	BMVW-1	MT20	4.0	9.0
J	BMVW-1	MT20	4.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQ'D BRG
JT	VERT	HORZ	DOWN	HORZ
J	980	0	980	0
H	980	0	980	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3'-8".

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	691	487.0	0.0	0.0	0.0	224.0	0.0
H	691	487.0	0.0	0.0	0.0	224.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0.735	-91.8 -91.8 0.12 (1)	10.00	I-D	0.460	0.10 (1)	
B-C	0.723	-91.8 -91.8 0.22 (1)	10.00	I-E	-206.0	0.10 (1)	
C-D	-685.0	-91.8 -91.8 0.17 (1)	6.25	C-I	-206.0	0.10 (1)	
D-E	-685.0	-91.8 -91.8 0.17 (1)	6.25	J-C	-985.0	0.44 (1)	
E-F	0.723	-91.8 -91.8 0.22 (1)	10.00	E-H	-985.0	0.44 (1)	
F-G	0.735	-91.8 -91.8 0.12 (1)	10.00				
J-B	-262.0	0.0 0.0 0.03 (1)	7.81				
H-F	-262.0	0.0 0.0 0.03 (1)	7.81				
J-I	0.701	-18.5 -18.5 0.37 (4)	10.00				
I-H	0.701	-18.5 -18.5 0.37 (4)	10.00				

TOTAL WEIGHT = 2 X 66 = 132 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.8	PSF
DL	= 6.0	PSF
BOT CH. LL	= 0.0	PSF
DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 8 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPC 2011, TPC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.52")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.52")
CALCULATED VERT. DEFL.(TL) = L/999 (0.09")

CSI: TC=0.22/1.00 (B-C:1), BC=0.37/1.00 (H-I:4),
WB=0.44/1.00 (C-J:1), SS=0.14/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	818 354 1667 788 1987 1658	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.81 (H) (INPUT = 0.90)


JSI METAL= 0.34 (C) (INPUT = 1.00)



Structural component only
DWG# T-2006829

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408318	T9S	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 23 15:33:04 2020 Page 1
ID: HJ7_mBNWkyCmBzl_hTT?DUzjdZA-iTqil3T92ER56eQA1F2ZsiS4ZICZVERnA4i54FzNpOD

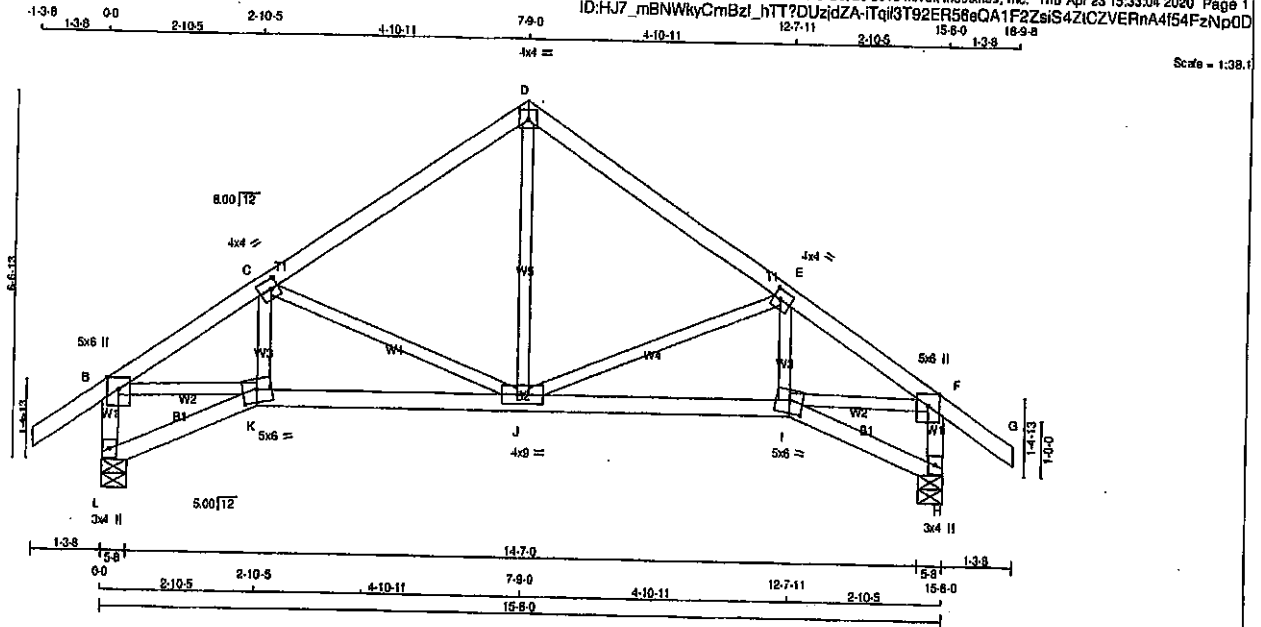

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - G	2x4	DRY	No.2	SPF		
L - B	2x4	DRY	No.2	SPF		
H - F	2x4	DRY	No.2	SPF		
L - K	2x4	DRY	No.2	SPF		
K - I	2x4	DRY	No.2	SPF		
I - H	2x4	DRY	No.2	SPF		

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMW+p	MT20	5.0	6.0	Edge	
C	TMWW-I	MT20	4.0	4.0	2.00	1.50
D	TTW-p	MT20	4.0	4.0	2.25	2.00
E	TMWW-I	MT20	4.0	4.0	2.00	1.50
F	TMW+p	MT20	5.0	6.0	Edge	
H	BMW-I+p	MT20	3.0	4.0		
I	BBWW-m	MT20	5.0	6.0	2.75	3.00
J	BBWWW-I	MT20	4.0	9.0		
K	BBWW-m	MT20	5.0	6.0	2.75	3.00
L	BMW-I+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORZ	BRG	BRG	IN-SX	IN-SX
L	980	0	980	0	0	5-8	5-8	5-8	5-8
H	980	0	980	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	691	467.0	0.0	0.0	0.0	224.0	0.0
H	691	467.0	0.0	0.0	0.0	224.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.49 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0/35	J-D	0/490
B-C	-1272/0	J-E	-463/0
C-D	-791/0	I-E	0/59
D-E	-791/0	C-J	-463/0
E-F	-1272/0	K-C	0/59
F-G	0/35	B-K	0/1087
L-B	-954/0	I-F	0/1087
H-F	-954/0		
L-K	0/0		
K-J	0/1085		
J-I	0/1085		
I-H	0/0		

TOTAL WEIGHT = 2 X 85 = 131 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.52")
CALCULATED VERT. DEFL.(LL) = 1/889 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.52")
CALCULATED VERT. DEFL.(TL) = 1/989 (0.08")

CSI: TC=0.25/1.00 (D-E:1), BC=0.24/1.00 (J-K:1),
WB=0.24/1.00 (B-K:1), SSI=0.17/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (B) (INPUT = 0.90)
JSI METAL = 0.52 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006830

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408318	T10	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 23 15:33:05 2020 Page 1
ID:HJ7_mBNWkyCmBzI_hTT?DUzjdZA-AfO4yPUmpYZyko?NbZzPw_FlHaxEjxwOKOfchzNp0C
8-2-9 12-7-0 1-3-8 13-10-8

Scale = 1:29.6

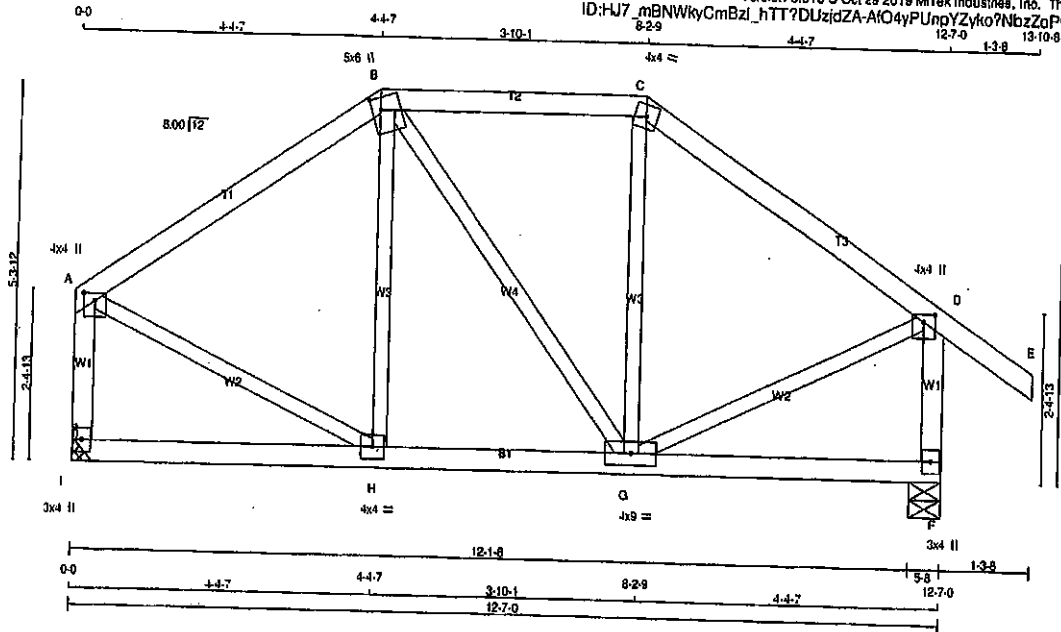

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - B	2x4	DRY	No.2	
B - C	2x4	DRY	No.2	
C - E	2x4	DRY	No.2	
I - A	2x4	DRY	No.2	
F - D	2x4	DRY	No.2	
I - F	2x4	DRY	No.2	

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TTWW+m	MT20	5.0	6.0	2.00	1.50
C	TTW-m	MT20	4.0	4.0		
D	TMVW+p	MT20	4.0	4.0	1.25	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMWWW-1	MT20	4.0	4.0	9.0	
H	BMWW-1	MT20	4.0	4.0		
I	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
I	694	0	694	0	5-8	5-8
F	820	0	820	0	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	491	322 / 0	0 / 0	0 / 0	0 / 0	169 0	0 / 0
F	577	392 / 0	0 / 0	0 / 0	0 / 0	185 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	-486 / 0	-91.8 -91.8	0.23 (1) 8.25	H-B	-106 / 26	0.04 (1)	
B-C	-401 / 0	-91.8 -91.8	0.17 (1) 6.25	B-G	0 / 0	0.00 (1)	
C-D	-486 / 0	-91.8 -91.8	0.23 (1) 8.25	G-C	-108 / 26	0.04 (1)	
D-E	0 / 35	-91.8 -91.8	0.12 (1) 10.00	A-H	0 / 445	0.10 (1)	
I-A	-659 / 0	0.0 0.0	0.08 (1) 7.81	G-D	0 / 445	0.10 (1)	
F-D	-784 / 0	0.0 0.0	0.10 (1) 7.81				
I-H	0 / 0	-18.5 -18.5	0.08 (4) 10.00				
H-G	0 / 402	-18.5 -18.5	0.11 (4) 10.00				
G-F	0 / 0	-18.5 -18.5	0.08 (4) 10.00				

TOTAL WEIGHT = 57 lb
(M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCO 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OSC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 038-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.42")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.01")
ALLOWABLE DEFL. (TL) = $L/360$ (0.42")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.02")

CSI: TC=0.23/1.00 (A-B:1), BC=0.11/1.00 (G-H:4), WB=0.10/1.00 (A-H:1), SS=0.14/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP (DRY)	SHEAR (PS)	SECTION (PL)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.55 (D) (INPUT = 0.80)
JSI METAL = 0.16 (D) (INPUT = 1.00)



Structural component only
DWG# T-2006831

Version 8.310 S Oct 28 2019 MTEK Industries, Inc. Thu Apr 23 15:38:32 2020 Page 1
ID: 5VQZPIKEWFOJ01UJWFAZccR-cUOLPB_d39ea3cK9DxnlZ3eHjAFEHhO?R28NBzNoyz



BEARINGS							
FACTORED GROSS REACTION			MAXIMUM FACTORED GROSS REACTION			INPUT BRG	RECORD BRG
JT	VERT	HORIZ	DOWN	HORIZ	UPLIFT	IN-SX	IN-SX
J	595	0	898	0	0	5-8	5-8
H	595	0	898	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H ≥ 3.8 .

UNFACTORED REACTIONS							
1ST LGASE		MAX. MIN. COMPONENT REACTIONS					
UT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	632	428 / 0	0 / 0	0 / 0	0 / 0	204 / 0	0 / 0
H	632	428 / 0	0 / 0	0 / 0	0 / 0	204 / 0	0 / 0

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED			
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	I-D	0 / 401	0.08 (1)
-C	0 / 20	-91.8	-91.8 0.18 (1)	10.00	I-E	-174 / 0	0.07 (1)
-D	-807 / 0	-91.8	-91.8 0.14 (1)	6.25	C-I	-174 / 0	0.07 (1)
-E	-807 / 0	-91.8	-91.8 0.14 (1)	6.25	J-C	-857 / 0	0.32 (1)
-F	0 / 20	-91.8	-91.8 0.18 (1)	10.00	E-H	-857 / 0	0.32 (1)
-G	0 / 35	-91.8	-91.8 0.12 (1)	10.00			
-H	-250 / 0	0.0	0.0 0.03 (1)	7.81			
-B	-250 / 0	0.0	0.0 0.03 (1)	7.81			
I	0 / 513	-18.5	-18.5 0.31 (4)	10.00			
H	0 / 513	-18.5	-18.5 0.31 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.0	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=		39.0	PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= $L/360$ (0.47")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.01")
ALLOWABLE DEFL.(TL)= $L/360$ (0.47")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.06")

CSI: TC=0.18/1.00 (B-C:1), BC=0.31/1.00 (I-J:4),
WB=0.32/1.00 (C-J:1), SSI=0.13/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS 8END=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)	(PSI)	(PLI)	(PLI)	(PLI)	(PLI)
	MAX	MIN	MAX	MIN	MAX	MIN
AT20	818	354	1687	788	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


SI GRIP= 0.73 (C) (INPUT = 0.90)
SI METAL= 0.30 (E) (INPUT = 1.00)



JOB NAME 408319	TRUSS NAME T21S	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	----------

Famarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Thu Apr 23 15:36:33 2020 Page 1
ID: 5VQZPIKEwF0J01uJWFAZjccR-4gyicW?FqSmRhmVnLnlagncpE7V7ziWY05nfvdzNowy

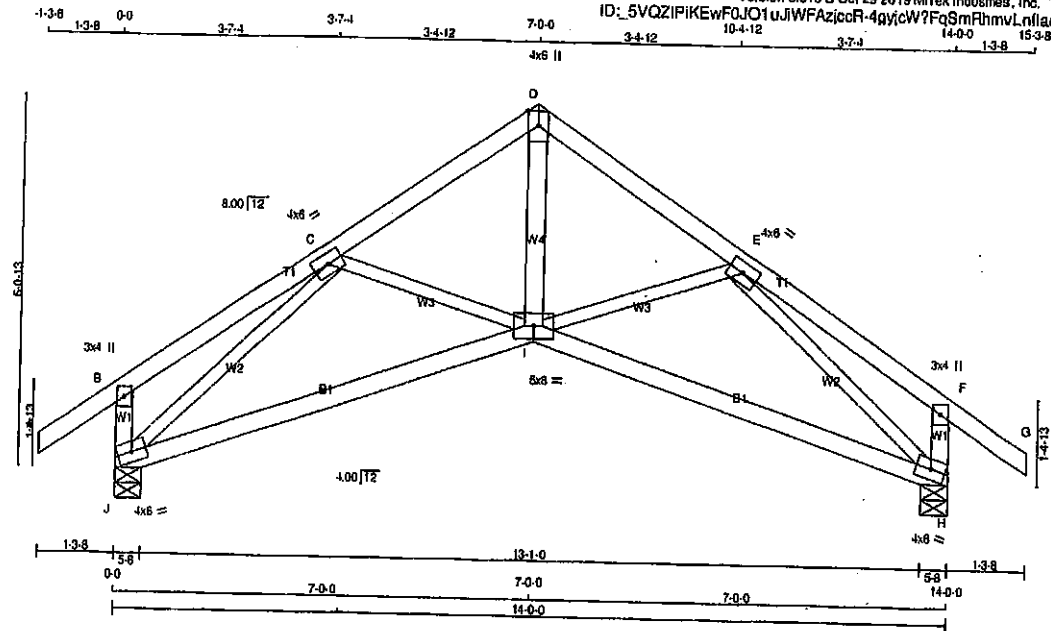

Scale = 1:34.8

LUMBER	N. L. & A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2	
D - G	2x4	DRY	No.2	
J - B	2x4	DRY	No.2	
H - F	2x4	DRY	No.2	
J - I	2x4	DRY	No.2	
I - H	2x4	DRY	No.2	

ALL WEBS 2x3 DRY No.2
EXCEPT
I - D 2x4 DRY No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV-p	MT20	3.0	4.0		
C	TMWW-1	MT20	4.0	6.0		
D	TTW-p	MT20	4.0	6.0		Edge
E	TMWW-1	MT20	4.0	6.0		
F	TMV-p	MT20	3.0	4.0		
H	BMVW-1	MT20	4.0	6.0		
I	BBWW-p	MT20	5.0	8.0		
J	BMVW-1	MT20	4.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
J	898	0	898	0
H	898	0	898	0

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	632	428.0	0.0	0.0	0.0	0.0	204.0	0.0
H	632	428.0	0.0	0.0	0.0	0.0	204.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRAC	MEMB.	WEBS MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO	LENGTH	FR-TO		
A-B	0.35	-91.8	-91.8	0.12 (1)	10.00	I-D	0.759
B-C	0.18	-91.8	-91.8	0.16 (1)	10.00	I-E	-95.16
C-D	-931.0	-91.8	-91.8	0.13 (1)	8.25	C-I	-95.16
D-E	-931.0	-91.8	-91.8	0.13 (1)	8.25	J-C	-1210.0
E-F	0.18	-91.8	-91.8	0.16 (1)	10.00	E-H	-1210.0
F-G	0.35	-91.8	-91.8	0.12 (1)	10.00		
J-B	-254.0	0.0	0.0	0.03 (1)	7.81		
H-F	-254.0	0.0	0.0	0.03 (1)	7.81		
J-I	0.895	-18.5	-18.5	0.33 (4)	10.00		
I-H	0.895	-18.5	-18.5	0.33 (4)	10.00		

TOTAL WEIGHT = 2 X 59 = 118 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 38.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.47")
CALCULATED VERT. DEFL. (LL) = L/999 (0.03")
ALLOWABLE DEFL. (TL) = L/360 (0.47")
CALCULATED VERT. DEFL. (TL) = L/999 (0.14")

CSI: TC=0.16/1.00 (B-C:1), BC=0.33/1.00 (I-J:4),
WB=0.48/1.00 (C-J:1), SS=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)	(PL)
MAX	MIN	MAX	MIN
MT20	618	354	1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.72 (J) (INPUT = 0.90)

JSI METAL = 0.29 (H) (INPUT = 1.00)

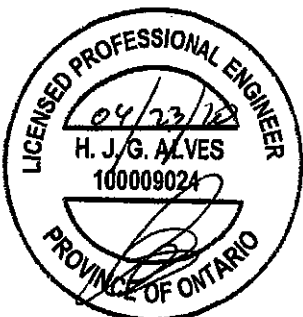


Structural component only
DWG# T-2006837

JOB NAME 408319	TRUSS NAME T22	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 23 15:36:34 2020 Page 1
ID: 5VQZPIKEwF0JO1uJWFAZjccR-YsW5qs0tbnulJwTXKMppN_8zuXvpiEnhSIXDR4zNoyX
8-22 12-7-0 13-10-8
Scale = 1:20.6

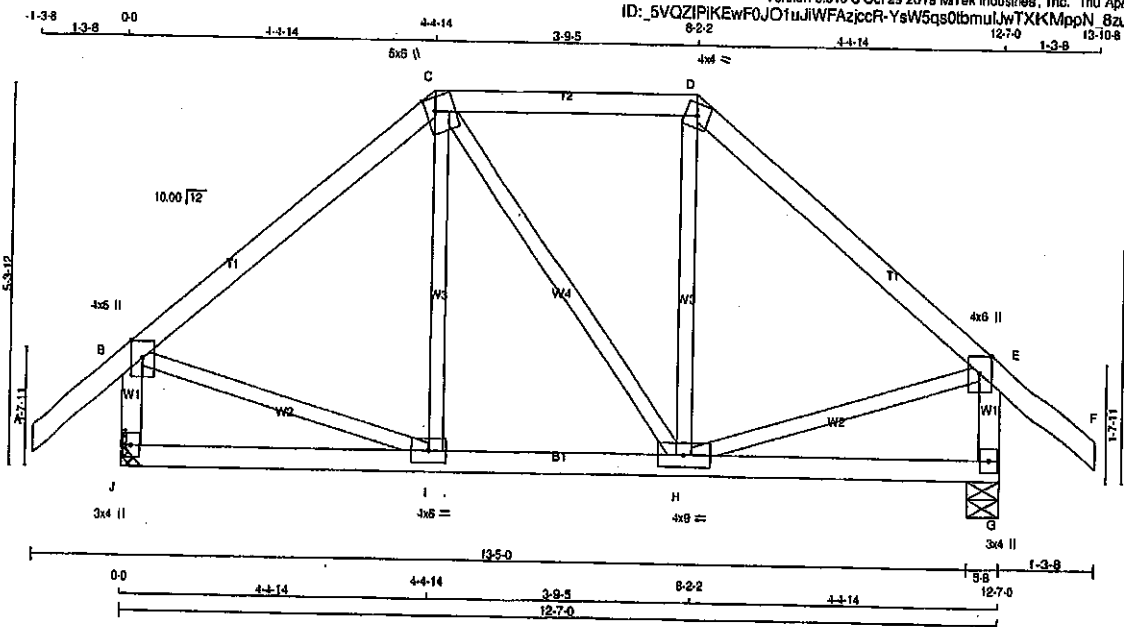

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - B	2x4	DRY	No.2	SPF	
G - E	2x4	DRY	No.2	SPF	
J - G	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	6.0	Edge	
C TTWW+m	MT20	5.0	6.0	2.25	1.50
D TTW-m	MT20	4.0	4.0		
E TMVW+p	MT20	4.0	6.0	Edge	
G BMV1+p	MT20	3.0	4.0		
H BMVWW-i	MT20	4.0	9.0		
I BMVWW-i	MT20	4.0	6.0		
J BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	DOWN	IN-SX	IN-SX
J 821	0	0	0
G 821	0	0	0
		MECHANICAL	MECHANICAL
		5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3-8.

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	578	393 / 0	0 / 0	0 / 0	0 / 0	185 / 0	0 / 0
G	578	393 / 0	0 / 0	0 / 0	0 / 0	185 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MAX. FACTORED		FACTORED		MAX. FACTORED		FACTORED		
MEMB.	FORCE	VERT. LOAD	MAX	MAX.	MEMB.	FORCE	MAX	
	(LBS)	(PLF)	CSI (LC)	UNBRAC		(LBS)	CSI (LC)	
FR-TO		FROM TO		LENGTH	FR-TO			
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	I-C	-38 / 50	0.02 (4)
B-C	-528 / 0	-91.8	-91.8	0.23 (1)	8.25	G-H	0 / 0	0.00 (1)
C-D	-404 / 0	-91.8	-91.8	0.17 (1)	8.25	H-I	-38 / 50	0.02 (4)
D-E	-528 / 0	-91.8	-91.8	0.23 (1)	8.25	B-I	0 / 421	0.09 (1)
E-F	0 / 41	-91.8	-91.8	0.13 (1)	10.00	H-E	0 / 421	0.09 (1)
J-B	-785 / 0	0.0	0.0	0.08 (1)	7.81			
G-E	-785 / 0	0.0	0.0	0.08 (1)	7.81			
J-I	0 / 0	-18.5	-18.5	0.08 (4)	10.00			
I-H	0 / 404	-18.5	-18.5	0.11 (4)	10.00			
H-G	0 / 0	-18.5	-18.5	0.08 (4)	10.00			

TOTAL WEIGHT = 58 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TRC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.42")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.01")
ALLOWABLE DEFL. (TL) = $L/360$ (0.42")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.02")

CS: TC=0.23/1.00 (B-C:1), BC=0.11/1.00 (H-I:4),
WB=0.09/1.00 (B-I:1), SI=0.14/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.51 (B) (INPUT = 0.90)
JSI METAL= 0.31 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006838

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 23 15:36:35 2020 Page 1

ID: 5VQZIPiKEwFJO1uJWfAZccR-134T1C1VM408w42ku3K2vCh6JxEOrgdhrPGmzWzNoyw


Scale = 1:29.6



Structural component only
DWG# T-2006839

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408319	T23X	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Fri Apr 24 07:48:35 2020 Page 1
ID: 5VQZPIKEWFOJO1uJWFAZjccR-Rs7r7rbwujDecUMLJdla7T14eMvj1LrbvCzNaig
13-8 0-0 4-0-11 4-0-11 5-8-9 9-9-3 5-8-9 15-0-12 15-4-8 17-0-12 3-12 1-8-4 3-11-1 20-11-13 5-8-9 28-8-8 4-8-10 31-5-0
Scale = 1:50.7

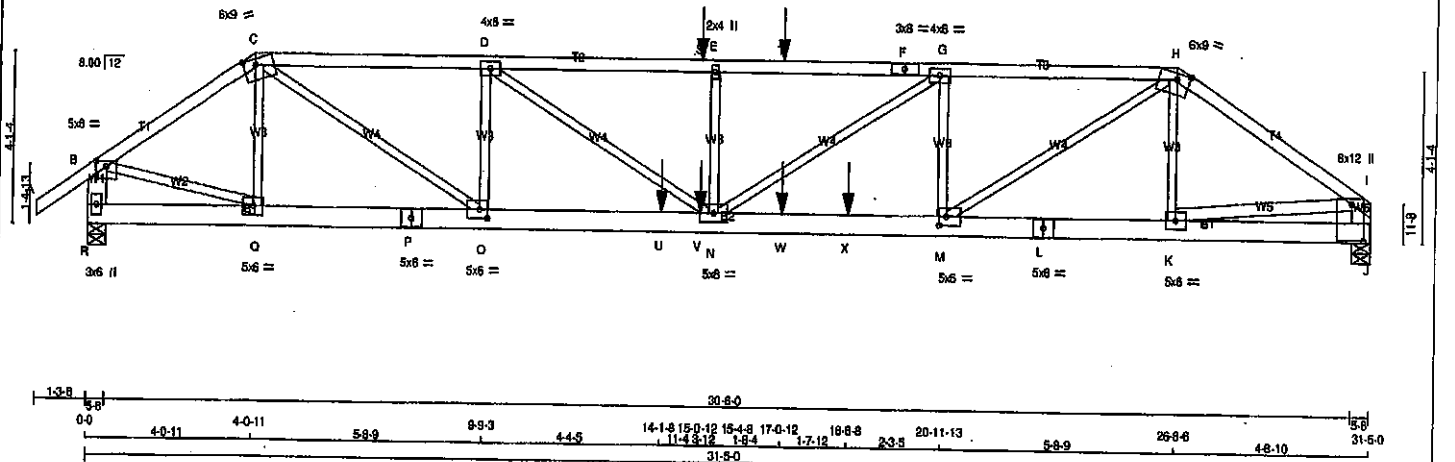

LUMBER	N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS				
A - C	2x4	DRY	No.2	SPF
C - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - I	2x4	DRY	No.2	SPF
R - B	2x8	DRY	No.2	SPF
J - I	2x8	DRY	No.2	SPF
R - P	2x8	DRY	1850F 1.5E	SPF
P - L	2x8	DRY	1850F 1.5E	SPF
L - J	2x8	DRY	1850F 1.5E	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
K - I	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C	12	TOP
C-F	12	TOP
F-H	12	TOP
H-I	12	TOP
R-B	2	TOP
J-I	2	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
R-P	2	TOP
P-L	2	TOP
L-J	2	TOP
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	6	TOP
2x4	6	TOP

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UPLIFT	IN-SX
R	3413	0	0	5-8
J	3401	0	0	5-8

UNFACTORED REACTIONS	1ST LOASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW
R	2405	1828 / 0
J	2398	1814 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.62 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING	CHORDS	FACTORED	WEBS	FACTORED
TOTAL LOAD CASES: (4)				
	MEMB.	FORCE	MEMB.	FORCE
	FR-TO	FROM TO	FR-TO	FROM TO
	A-B	0 / 35	A-B	0 / 35
	B-C	-4060 / 0	B-C	-4060 / 0
	C-D	-7310 / 0	C-D	-7310 / 0
	D-E	-9818 / 0	D-E	-9818 / 0
	E-F	-9818 / 0	E-F	-9818 / 0
	F-G	-9818 / 0	F-G	-9818 / 0
	G-H	-8098 / 0	G-H	-8098 / 0
	H-I	-4801 / 0	H-I	-4801 / 0
	R-B	-3381 / 0	R-B	-3381 / 0
	J-I	-3345 / 0	J-I	-3345 / 0
	R-Q	0 / 0	R-Q	0 / 0
	Q-P	0 / 3352	Q-P	0 / 3352
	P-O	0 / 3352	P-O	0 / 3352
	O-U	0 / 7311	O-U	0 / 7311
	U-V	0 / 7311	U-V	0 / 7311
	V-N	0 / 7311	V-N	0 / 7311
	N-W	0 / 8098	N-W	0 / 8098
	W-X	0 / 8098	W-X	0 / 8098
	X-M	0 / 8098	X-M	0 / 8098
	M-L	0 / 3978	M-L	0 / 3978
	L-K	0 / 3978	L-K	0 / 3978
	K-J	0 / 0	K-J	0 / 0

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
	S	15-0-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
	T	17-0-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
	U	14-1-8	-1562	-1562	---	BACK	VERT	TOTAL	---	C1
	V	15-0-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
	W	17-0-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
	X	18-8-8	-1389	-1389	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) G1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 141 = 282 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2015 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.05")
CALCULATED VERT. DEFL.(LL) = L/899 (0.28")
ALLOWABLE DEFL.(TL) = L/360 (1.05")
CALCULATED VERT. DEFL.(TL) = L/797 (0.47")

CSI: TC=0.82/1.00 (E-G:1), BC=0.68/1.00 (M-N:1), WB=0.61/1.00 (H-M:1), SS=0.47/1.00 (N-O:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(P.S.) (PL) (PL)
MIN MAX MIN MAX MIN
MT20 618 354 1587 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.89 (H) (INPUT = 0.90)
JSI METAL= 0.51 (M) (INPUT = 1.00)



Structural component only
DWG# T-2006840 1/2


CONTINUED ON PAGE 2

JOB NAME 408319	TRUSS NAME T23X	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 24 07:48:35 2020 Page 2
ID: 5VQZiPiKEwF0JO1uJiWFAzicR-Rs7r7rpbwuiDecUMLJdlai7T4eMvj1LrbvCzNalg

PLATES (table in inches)


JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	6.0	1.50	3.00
C	TTWW-m	MT20	6.0	9.0	1.75	3.50
D	TMWW-t	MT20	4.0	6.0		
E	TMW-w	MT20	2.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMWW-t	MT20	4.0	6.0		
H	TTWW-m	MT20	6.0	9.0	1.75	3.50
I						
J	TMBWV1-p	MT20	8.0	12.0	10.25	3.50
K	BMWW-t	MT20	5.0	6.0		
L	BS-t	MT20	5.0	6.0		
M	BMWW-t	MT20	5.0	6.0	2.50	2.00
N	BMWW-t	MT20	5.0	6.0		
O	BMWW-t	MT20	5.0	6.0	2.50	2.25
P	BS-t	MT20	5.0	6.0		
Q	BMWW-t	MT20	5.0	6.0		
R	BMV1-p	MT20	3.0	6.0		

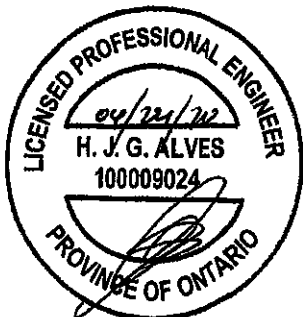

Structural component only
DWG# T-2006840 *4/2*

JOB NAME 408320	TRUSS NAME T31	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 23 18:25:57 2020 Page 1
 ID:7ILg53GdMK5ISQleanm7D6za3y-lu2Eh0ITp8C#HGU7P8TayqMJYx4QRF3ppEnVxqzNoEe
 23-11-4 24-10-8 11-4 5-10-8 30-9-0 32-0-8
 Scale = 1:50.9

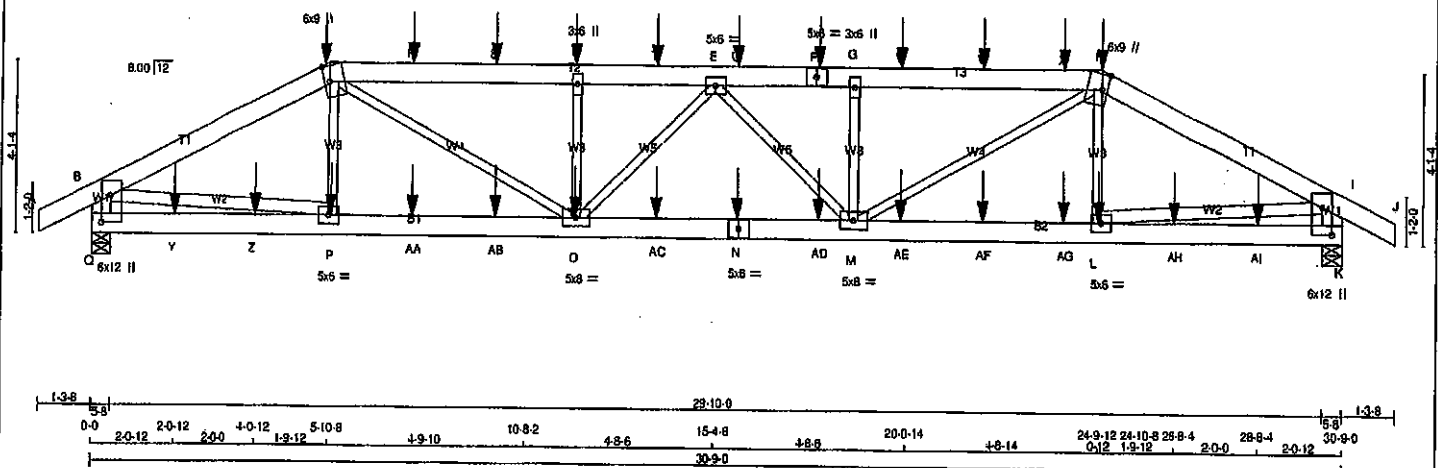

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x8	DRY	No.2
C - F	2x6	DRY	No.2
F - H	2x6	DRY	No.2
H - J	2x6	DRY	No.2
Q - B	2x6	DRY	No.2
K - I	2x6	DRY	No.2
Q - N	2x6	DRY	No.2
N - K	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
B - P	2x4	DRY	No.2
L - I	2x4	DRY	No.2

DRY: SEASONED LUMBER.
 DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	SIDE (122.0)
C - F	12	SIDE (183.1)
F - H	12	SIDE (81.0)
H - J	12	SIDE (122.0)
Q - B	12	TOP
K - I	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
Q - N	12	SIDE (183.1)
N - K	12	SIDE (183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	8	
2x4	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.
 GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.
 TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
JT	GROSS REACTION	GROSS REACTION	DOWN	UP	BRG
Q	2955	0	2955	0	5-8
K	3001	0	3001	0	5-8

UNFACTORED REACTIONS							
	1ST LOASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
Q	2088	1377.0	0.0	0.0	0.0	711.0	0.0
K	2121	1398.0	0.0	0.0	0.0	723.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, K
 BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.58 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
 ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING		TOTAL LOAD CASES: (4)	
CHORDS	MEMB.	FORCE (LBS)	CS (LC)
FR-TO			
A-B	0/29	-91.8	-91.8 0.03 (1)
B-C	-4519/0	-91.8	-91.8 0.19 (1)
C-R	-8037/0	-91.8	-91.8 0.26 (1)
R-S	-8037/0	-91.8	-91.8 0.28 (1)
S-D	-8037/0	-91.8	-91.8 0.28 (1)
D-T	-8037/0	-91.8	-91.8 0.18 (1)
T-E	-8037/0	-91.8	-91.8 0.18 (1)
E-U	-8071/0	-91.8	-91.8 0.19 (1)
U-F	-8071/0	-91.8	-91.8 0.19 (1)
F-G	-8071/0	-91.8	-91.8 0.19 (1)
G-V	-8071/0	-91.8	-91.8 0.27 (1)
V-W	-8071/0	-91.8	-91.8 0.27 (1)
W-X	-8071/0	-91.8	-91.8 0.27 (1)
X-H	-8071/0	-91.8	-91.8 0.27 (1)
H-I	-4603/0	-91.8	-91.8 0.19 (1)
I-J	0/29	-91.8	-91.8 0.03 (1)
Q-B	-2888/0	0.0	0.0 0.10 (1)
K-I	-2932/0	0.0	0.0 0.10 (1)
WEBS			
FR-TO			
P-C	-246/79	0.03	0.03 (1)
C-O	0/2338	0.29	0.29 (1)
O-D	-849/0	0.10	0.10 (1)
D-E	-216/0	0.04	0.04 (1)
E-M	-167/0	0.03	0.03 (1)
M-G	-857/0	0.10	0.10 (1)
G-H	0/2288	0.28	0.28 (1)
H-P	-241/91	0.03	0.03 (1)
P-L	0/4065	0.38	0.38 (1)
L-I	0/4140	0.37	0.37 (1)

FACTORED CONCENTRATED LOADS (LBS)		LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
JT	5-10-8	-459	-459	---	---	FRONT	VERT	TOTAL	---	C1
D	11-11-4	-110	-110	---	---	FRONT	VERT	TOTAL	---	C1
F	17-11-4	-110	-110	---	---	FRONT	VERT	TOTAL	---	C1
H	24-10-8	-459	-459	---	---	FRONT	VERT	TOTAL	---	C1

TOTAL WEIGHT = 2 X 181 = 322 lb

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF NBC 2010, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(56% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEF. (LL) = L/360 (1.03')
 CALCULATED VERT. DEF. (LL) = L/999 (0.13')
 ALLOWABLE DEF. (TL) = L/360 (1.03')
 CALCULATED VERT. DEF. (TL) = L/999 (0.24')

CSI: TC=0.27/1.00 (G-H:1), BC=0.47/1.00 (M-O:1), WB=0.37/1.00 (L-I:1), SS=0.17/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES	
PLATE GRIP (DRY)	SHEAR SECTION
(PS)	(PL)
MAX MIN	MAX MIN
MT20	618 354 1867 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (L) (INPUT = 0.90)
 JSI METAL = 0.74 (K) (INPUT = 1.00)



Structural component only
 DWG# T-2008846 1/2

JOB NAME 408320	TRUSS NAME T31	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 23 18:26:57 2020 Page 2	
ID:7ilG53GdMK5ISQteanm7D6zia3y-lu2Eh0ITp8CiHGU?P8T8vgMjYx4QRF3ppEnVxzNoEe					

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	I, K, Q				
C	TTWW+m	MT20	6.0	9.0	4.50 1.50
D	TMW+w	MT20	3.0	8.0	
E	TMW-w	MT20	5.0	8.0	
F	TS-I	MT20	5.0	8.0	
G	TMW+w	MT20	3.0	8.0	
H	TTWW+m	MT20	6.0	9.0	4.50 1.50
K	TMBMWV1'+p	MT20	6.0	12.0	7.75 2.75
L	BMWV4	MT20	5.0	8.0	
M	BMWVW-1	MT20	5.0	8.0	
N	BS-I	MT20	5.0	8.0	
O	BMWVW-1	MT20	5.0	8.0	
P	BMWV4	MT20	5.0	8.0	
Q	TMBMWV1'+p	MT20	6.0	12.0	7.75 2.75

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
L	24-9-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
N	15-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
O	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
P	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
R	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
S	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
T	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	19-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	21-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	23-11-4	-113	-113	---	FRONT	VERT	TOTAL	---	C1
Y	2-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Z	4-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AA	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AB	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AC	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AD	17-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AE	19-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AF	21-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	23-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	26-8-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	28-8-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2006847 *1/2*

JOB NAME 408320	TRUSS NAME T31X	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 8 Oct 29 2019 MTEK Industries, Inc. Fri Apr 24 08:02:56 2020 Page 2
ID:7ILg53GdMK5l5Qleanm7D6zja3y-IVXKqFEg9RC3RwprHegC HHIX9Vn8HAmLJfseozNaWD

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B						
C	TTWW-m	MT20	7.0	8.0	3.25	2.25
D	TMW+w	MT20	3.0	8.0		
E	TMWW-t	MT20	5.0	8.0		
F	TS-t	MT20	5.0	8.0		
G	TMW+w	MT20	3.0	8.0		
H	TTWW-m	MT20	6.0	9.0	3.00	2.50
I	TBMH-t	MT20	6.0	9.0	3.00	2.50
J	BMW+w	MT20	3.0	8.0		
K	BS-t	MT20	5.0	8.0		
L	BMWWW-t	MT20	5.0	8.0	2.50	2.25
M	BMWWW-t	MT20	5.0	12.0		
N	BS-t	MT20	5.0	8.0		
O	BMWW-t	MT20	5.0	8.0	2.50	3.75
P						
P	TBMVW1*+pMT20		7.0	12.0	7.75	3.00


CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2008847 72

JOB NAME 408320	TRUSS NAME T32	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 23 18:25:59 2020 Page 1 ID:7ILg53GdMK5ISQleanm7D6zja3y-EHA_BiujLmSbWaoOXZV62FSWxkWw386FYGc0jzNoEc			

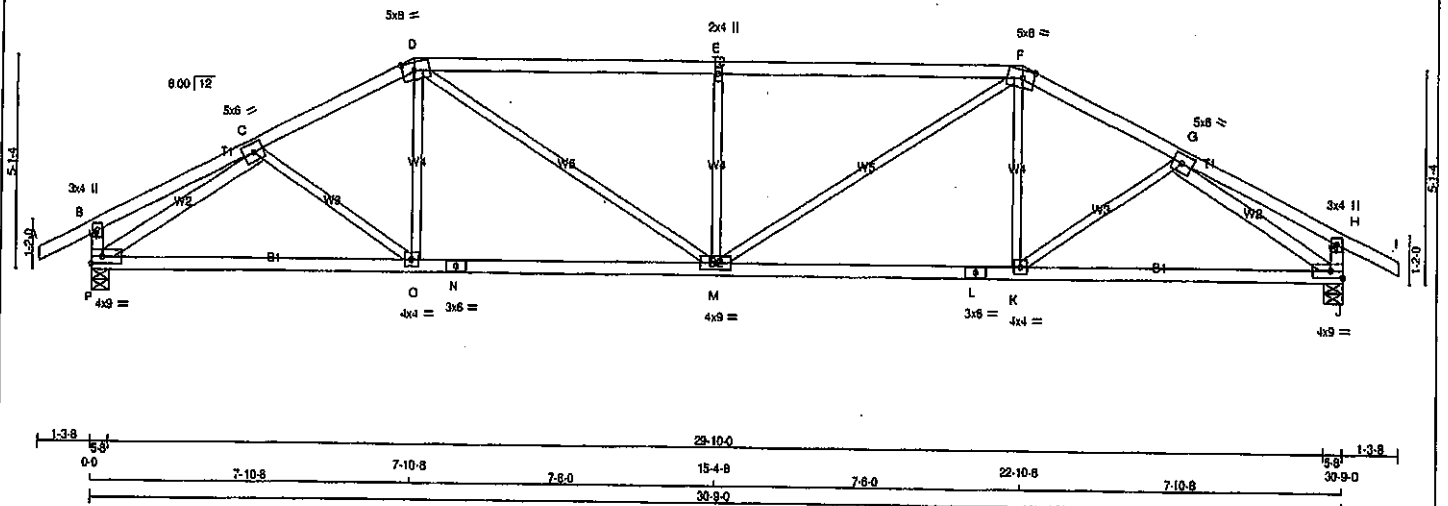

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
P - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
L - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
P - C	2x4	DRY	No.2
G - J	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	X
B	TMV+p	MT20	3.0	4.0	
C	TMVW-1	MT20	5.0	6.0	
D	TTWW-m	MT20	5.0	8.0	2.25 3.50
E	TMVW-1	MT20	2.0	4.0	
F	TTWW-m	MT20	5.0	8.0	2.25 3.50
G	TMVW-1	MT20	5.0	6.0	
H	TMV+p	MT20	3.0	4.0	
J	BMVW1-1	MT20	4.0	9.0	Edge
K	BMVW1-1	MT20	4.0	4.0	
L	BS-1	MT20	3.0	6.0	
M	BMVW1-1	MT20	4.0	9.0	
N	BS-1	MT20	3.0	6.0	
O	BMVW1-1	MT20	4.0	4.0	
P	BMVW1-1	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	GROSS REACTION	VERT	HORZ	DOWN	HORZ	UPLIFT	BRG	BRG	IN-SX
P	1820	0	1820	0	0	5-8	5-8	5-8	5-8
J	1820	0	1820	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST CASE		MAX./MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
P	1284	856 / 0	0 / 0	0 / 0	0 / 0	428 / 0	0 / 0		
J	1284	856 / 0	0 / 0	0 / 0	0 / 0	428 / 0	0 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.08 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	MAX. LC1 (LC)
FR-TO				FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	C-O	0 / 88	0.02 (4)
B-C	0 / 17	-91.8	-91.8 0.20 (1)	10.00	D-M	0 / 159	0.05 (4)
C-D	-2355 / 0	-91.8	-91.8 0.22 (1)	4.29	E-F	0 / 897	0.20 (1)
D-E	-2847 / 0	-91.8	-91.8 0.88 (1)	3.08	F-G	-848 / 0	0.33 (1)
E-F	-2847 / 0	-91.8	-91.8 0.88 (1)	3.08	G-H	0 / 897	0.20 (1)
F-G	-2355 / 0	-91.8	-91.8 0.22 (1)	4.29	H-I	0 / 17	0.02 (4)
G-H	0 / 17	-91.8	-91.8 0.20 (1)	10.00	I-J	0 / 28	0.03 (1)
H-I	0 / 28	-91.8	-91.8 0.12 (1)	10.00	J-K	-269 / 0	0.71 (1)
I-J	-269 / 0	0.0	0.0 0.03 (1)	7.81	K-L	-269 / 0	0.71 (1)
J-K	-269 / 0	0.0	0.0 0.03 (1)	7.81			
P-O	0 / 2081	-18.5	-18.5 0.49 (1)	10.00			
O-N	0 / 2082	-18.5	-18.5 0.49 (1)	10.00			
N-M	0 / 2082	-18.5	-18.5 0.49 (1)	10.00			
M-L	0 / 2082	-18.5	-18.5 0.49 (1)	10.00			
L-K	0 / 2082	-18.5	-18.5 0.49 (1)	10.00			
K-J	0 / 2081	-18.5	-18.5 0.49 (1)	10.00			

TOTAL WEIGHT = 120 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/999 (0.26")

CSI: TC=0.88/1.00 (E-F:1), BC=0.49/1.00 (M-O:1),
WB=0.71/1.00 (G-J:1), SS=0.33/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.60 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.60 (F) (INPUT = 0.90)

JSI METAL = 0.71 (N) (INPUT = 1.00)



Structural component only
DWG# T-2006848

Tamareck Roof Truss, Burlington


Version 8.310 S.Oct 29 2019 MTek Industries, Inc. Fri Apr 24 08:02:57 2020 Page 1

ID: ?Lg53GdMK655Qteanm7D62ja3y-Bi4i1aFwKw24O1rL5RWLqlsZt0tgvzZPPAEzNaWc


1-3-8 0-0 4-0-8 4-0-8 7-10-8 15-4-8 7-8-0 3-10-0 29-8-8 30-9-0 32-0-8

1-3-8 4-0-8 3-10-0 7-8-0 3-10-0 29-8-8 4-0-8 30-9-0 1-3-8

Scale = 1/4" = 1'-0"

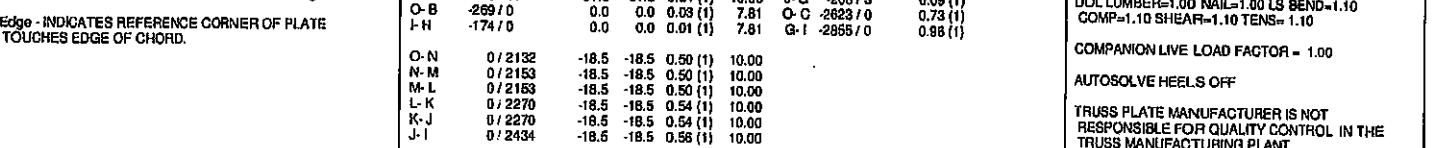

JOB NAME 408320	TRUSS NAME T33	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 5 Oct 2019 M&T Industries, Inc. Thu Apr 23 16:28:01 2020 Page 1	
ID:7iLg53GdMK5i5Qtearum7D6zja3y-BqIkXOwz9Njmuome_Ya7gXz3YSEN1wPjail4bzNoEa				32-0-8 13-8 Scale = 1:50.9	

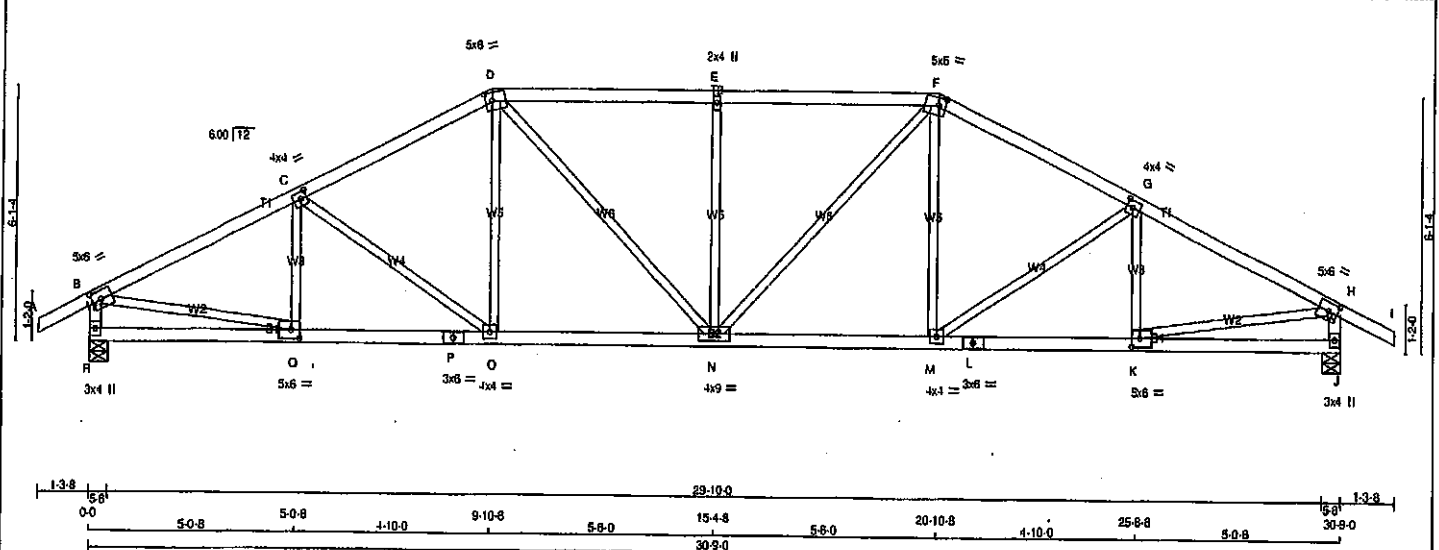

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
I - H	2x4	DRY	No.2	SPF
H - B	2x4	DRY	No.2	SPF
B - P	2x4	DRY	No.2	SPF
P - L	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
DRY: SEASONED LUMBER.				

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMVW-1	MT20	5.0	6.0	2.50	2.75
C TMVW-1	MT20	4.0	4.0	2.00	1.75
D TTWW-m	MT20	5.0	6.0	2.25	2.00
E TMVW-w	MT20	2.0	4.0		
F TTWW-m	MT20	5.0	6.0	2.25	2.00
G TMVW-1	MT20	4.0	4.0	2.00	1.75
H TMVW-1	MT20	5.0	6.0	2.50	2.75
J BMV1+p	MT20	3.0	4.0		
K BMVW-1	MT20	5.0	6.0	2.50	2.50
L BS-1	MT20	3.0	6.0		
M BMVW-1	MT20	4.0	4.0		
N BMVW-1	MT20	4.0	9.0		
O BMVW-1	MT20	4.0	4.0		
P BS-1	MT20	3.0	6.0		
Q BMVW-1	MT20	5.0	6.0	2.50	2.50
R BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
	FACTORED	MAXIMUM FACTORED	INPUT	REQD					
	GROSS REACTION	GROSS REACTION	BRG	BRG					
JT VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX			
R	1820	0	1820	0	0	5-8			
J	1820	0	1820	0	0	5-8			
UNFACTORED REACTIONS									
1ST LCASE	MAX. MIN. COMPONENT REACTIONS								
JT COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL			
R	1284	858 / 0	0 / 0	0 / 0	428 / 0	0 / 0			
J	1284	858 / 0	0 / 0	0 / 0	428 / 0	0 / 0			
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J									
BRACING									
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.08 FT.									
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.									
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.									
LOADING									
TOTAL LOAD CASES: (4)									
CHORDS									
MEMB.	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED					
	FORCE (LBS)	VERT. LOAD (LBS)		FORCE (LBS)					
FR-TO		FROM TO	LENGTH	FR-TO					
A-B	0 / 28	-91.8 -91.8 0.12 (1)	10.00	Q-C	-282 / 0	0.08 (1)			
B-C	-2432 / 0	-91.8 -91.8 0.36 (1)	4.10	C-D	-283 / 0	0.18 (1)			
C-D	-2218 / 0	-91.8 -91.8 0.34 (1)	4.27	D-E	0 / 282	0.08 (1)			
D-E	-2304 / 0	-91.8 -91.8 0.43 (1)	4.09	E-F	0 / 492	0.11 (1)			
E-F	-2304 / 0	-91.8 -91.8 0.43 (1)	4.09	F-G	-617 / 0	0.36 (1)			
F-G	-2218 / 0	-91.8 -91.8 0.34 (1)	4.27	G-H	0 / 492	0.11 (1)			
G-H	-2432 / 0	-91.8 -91.8 0.36 (1)	4.10	H-I	0 / 282	0.06 (1)			
H-I	0 / 28	-91.8 -91.8 0.12 (1)	10.00	I-J	-283 / 0	0.18 (1)			
I-J	-1777 / 0	0.0 0.0 0.18 (1)	6.26	J-K	-282 / 0	0.06 (1)			
J-K	-1777 / 0	0.0 0.0 0.18 (1)	6.26	K-L	0 / 2227	0.50 (1)			
K-L	0 / 0	-18.5 -18.5 0.10 (4)	10.00	L-M	0 / 2227	0.50 (1)			
L-M	0 / 2185	-18.5 -18.5 0.41 (1)	10.00	M-N	0 / 2185				
M-N	0 / 2185	-18.5 -18.5 0.41 (1)	10.00	N-O	0 / 1988				
N-O	0 / 1988	-18.5 -18.5 0.37 (1)	10.00	O-P	0 / 1988				
O-P	0 / 1988	-18.5 -18.5 0.37 (1)	10.00	P-Q	0 / 2185				
P-Q	0 / 2185	-18.5 -18.5 0.41 (1)	10.00	Q-R	0 / 2185				
Q-R	0 / 2185	-18.5 -18.5 0.41 (1)	10.00	R-S	0 / 0				
R-S	0 / 0	-18.5 -18.5 0.10 (4)	10.00	S-T	0 / 0				
S-T	0 / 0	-18.5 -18.5 0.10 (4)	10.00	T-U	0 / 0				
T-U	0 / 0	-18.5 -18.5 0.10 (4)	10.00	U-V	0 / 0				
U-V	0 / 0	-18.5 -18.5 0.10 (4)	10.00	V-W	0 / 0				
V-W	0 / 0	-18.5 -18.5 0.10 (4)	10.00	W-X	0 / 0				
W-X	0 / 0	-18.5 -18.5 0.10 (4)	10.00	X-Y	0 / 0				
X-Y	0 / 0	-18.5 -18.5 0.10 (4)	10.00	Y-Z	0 / 0				
Y-Z	0 / 0	-18.5 -18.5 0.10 (4)	10.00	Z-A	0 / 0				

DESIGN CRITERIA		
SPECIFIED LOADS:		
TOP CH. LL	=	25.6 PSF
DL	=	6.0 PSF
BOT CH. LL	=	0.0 PSF
DL	=	7.4 PSF
TOTAL LOAD	=	39.0 PSF
SPACING = 24.0 IN. C/C		
LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM		
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015		
THIS DESIGN COMPLIES WITH:		
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019		
- PART 9 OF OBC 2012 (2019 AMENDMENT)		
- CSA 086-09, CSA 086-14		
- TPIC 2011, TPIC 2014		
(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD		
ALLOWABLE DEFL.(LL) = L/360 (1.02")		
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")		
ALLOWABLE DEFL.(TL) = L/360 (1.02")		
CALCULATED VERT. DEFL.(TL) = L/999 (0.21")		
CSI: TC=0.43/1.00 (D-E:1), BC=0.41/1.00 (K-M:1), WB=0.50/1.00 (H-K:1), SSI=0.24/1.00 (E-F:1)		
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10		
COMPANION LIVE LOAD FACTOR = 1.00		
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.		
NAIL VALUES		
PLATE GRIP(DRY)	SHEAR (PS)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1657 788
PLATE PLACEMENT TOL. = 0.250 inches		
PLATE ROTATION TOL. = 5.0 Deg.		
JSI GRIP= 0.90 (B) (INPUT = 0.90)		
JSI METAL= 0.85 (H) (INPUT = 1.00)		

Structural component only
DWG# T-2006850




Structural component only
DWG# T-2006850

JOB NAME 408320	TRUSS NAME T34	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 23 16:28:03 2020 Page 1

ID:7iLg53GdMK5l5Gtearim7D8zja3y-fss7KobdhaqAN1NzCh3pfr468yoy6U5YyWUGc1zNoEZ

Scale = 1:50.0

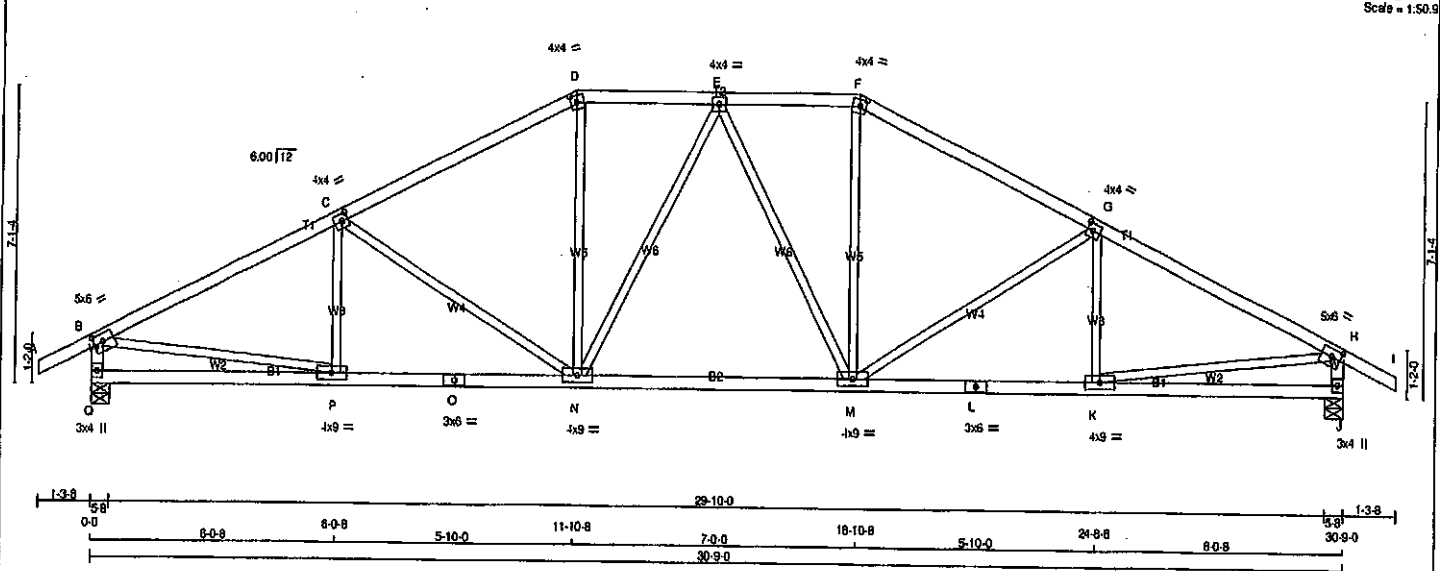

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
Q - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
O - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
L - J	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y
B	TMVW-t	MT20	5.0	6.0	2.25
C	TMVW-t	MT20	4.0	4.0	2.00
D	TTW-m	MT20	4.0	4.0	2.00
E	TMVW-t	MT20	4.0	4.0	
F	TTW-m	MT20	4.0	4.0	2.00
G	TMVW-t	MT20	4.0	4.0	2.00
H	TMVW-t	MT20	5.0	6.0	2.25
J	BMV-t+p	MT20	3.0	4.0	
K	BMVW-t	MT20	4.0	9.0	
L	BS-t	MT20	3.0	8.0	
M	BMVW-t	MT20	4.0	9.0	
N	BMVW-t	MT20	4.0	9.0	
O	BS-t	MT20	3.0	8.0	
P	BMVW-t	MT20	4.0	9.0	
Q	BMV-t+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
Q	1820	0	1820	0	5-8
J	1820	0	1820	0	5-8

UNFACTORED REACTIONS		1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
Q	1284	856 / 0	0 / 0
J	1284	856 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.88 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)	UNBRACED LENGTH
FR-TO				FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	P-C	-202 / 27	0.05 (1)
B-C	-2486 / 0	-91.8	-91.8 0.53 (1)	3.88	C-N	-490 / 0	0.47 (1)
C-D	-2085 / 0	-91.8	-91.8 0.48 (1)	4.22	N-D	0 / 580	0.13 (1)
D-E	-1829 / 0	-91.8	-91.8 0.16 (1)	4.82	N-E	-213 / 0	0.25 (1)
E-F	-1829 / 0	-91.8	-91.8 0.16 (1)	4.82	E-M	-213 / 0	0.25 (1)
F-G	-2085 / 0	-91.8	-91.8 0.48 (1)	4.22	M-F	0 / 580	0.13 (1)
G-H	-2486 / 0	-91.8	-91.8 0.53 (1)	3.88	M-G	-490 / 0	0.47 (1)
H-I	0 / 28	-91.8	-91.8 0.12 (1)	10.00	K-G	-202 / 27	0.05 (1)
Q-B	-1771 / 0	0.0	0.0 0.18 (1)	8.27	B-P	0 / 2253	0.51 (1)
J-H	-1771 / 0	0.0	0.0 0.18 (1)	8.27	K-H	0 / 2253	0.51 (1)
Q-P	0 / 0	-18.5	-18.5 0.14 (4)	10.00			
P-O	0 / 2230	-18.5	-18.5 0.44 (1)	10.00			
O-N	0 / 2230	-18.5	-18.5 0.44 (1)	10.00			
N-M	0 / 1924	-18.5	-18.5 0.39 (1)	10.00			
M-L	0 / 2230	-18.5	-18.5 0.44 (1)	10.00			
L-K	0 / 2230	-18.5	-18.5 0.44 (1)	10.00			
K-J	0 / 0	-18.5	-18.5 0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL) = L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CSI: TC=0.53/1.00 (B-C:1), BC=0.44/1.00 (N-P:1), WB=0.51/1.00 (B-P:1), SSI=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MT20	618	354	1887
	788	1987	1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.88 (D) (INPUT = 0.90)
JSI METAL= 0.71 (C) (INPUT = 1.00)



Structural component only
DWG# T-2006851

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408320	T34X	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 24 08:02:58 2020 Page 1
 ID:7iLq53GdMK5i5Qteanm7D6ja3y-gue5FwFwh2SngEzEP3cg3iN_qzDKcAn3od8zlgzNaVbW
 1-3-8 0-0 6-0-8 6-0-8 5-10-0 11-10-8 3-6-0 13-4-8 3-6-0 18-10-8 5-10-0 24-5-8 6-0-8 1-3-8
 Scale = 1:50.0

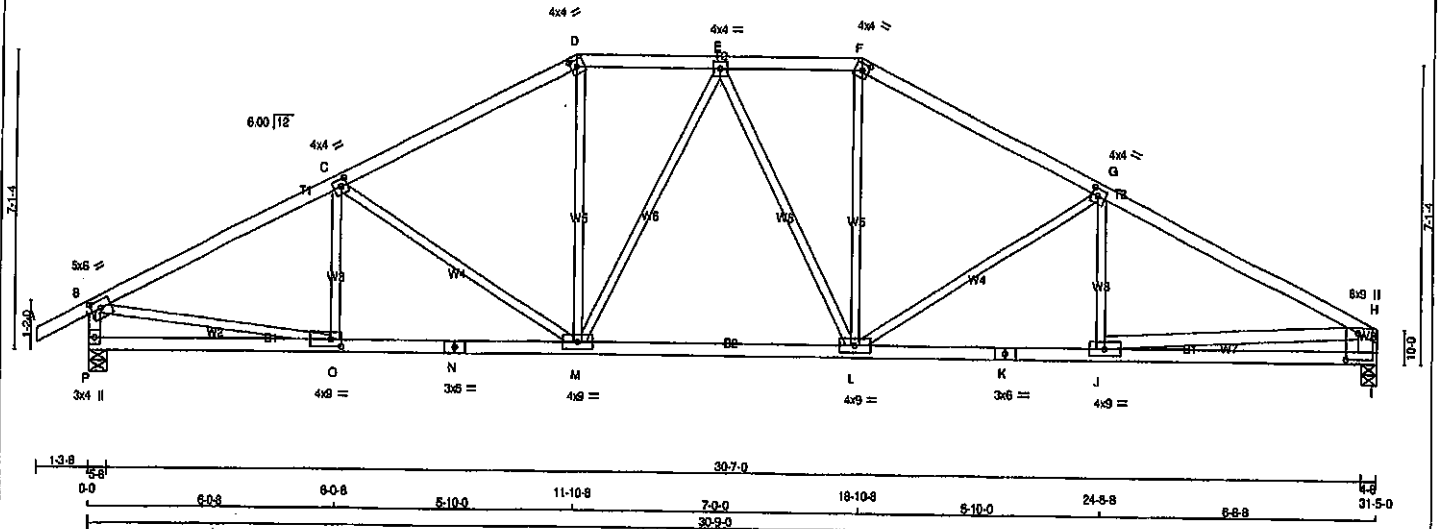

LUMBER			
N.L.G.A. RULES			
CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
P - 8	2x4	DRY	No.2
I - H	2x8	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
J - H	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMVW-1	MT20	5.0	8.0	2.25 2.75
C TMVW-1	MT20	4.0	4.0	2.00 1.75
D TTW-h	MT20	4.0	4.0	2.00 1.75
E TMVW-1	MT20	4.0	4.0	
F TTW-h	MT20	4.0	4.0	2.00 1.75
G TMVW-1	MT20	4.0	4.0	2.00 1.75
H				
I				
J BMVW-1	MT20	4.0	9.0	
K BS-1	MT20	3.0	6.0	
L BMVW-1	MT20	4.0	9.0	
M BMVW-1	MT20	4.0	9.0	
N BS-1	MT20	3.0	6.0	
O BMVW-1	MT20	4.0	9.0	2.00 3.00
P BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
JT	GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
P	1858 0	1858 0	0 0	5-8	5-8
I	1732 0	1732 0	0 0	4-8	4-8

UNFACTORED REACTIONS		1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE PERM. LIVE WIND DEAD SOIL
P	1310	873 / 0	0 / 0 0 / 0 0 / 0 437 / 0 0 / 0
I	1225	804 / 0	0 / 0 0 / 0 0 / 0 421 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I
 BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.53 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
 ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING		CHORDS		WEBS	
TOTAL LOAD CASES: (4)		MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
		FR-TO	FROM TO	FR-TO	FROM TO
		A-B	0 / 28	O-C	-211 / 24
		B-C	-2528 / 0	C-M	-481 / 0
		C-D	-2137 / 0	M-D	0 / 611
		D-E	-1884 / 0	E-F	-253 / 0
		E-F	-1930 / 0	F-G	-172 / 0
		F-G	-2181 / 0	G-H	0 / 638
		G-H	-2745 / 0	H-I	-689 / 0
		I-H	-1807 / 0	J-G	-70 / 79
				B-O	0 / 2310
				J-H	0 / 2488
		P-O	0 / 0		
		O-N	0 / 2287		
		N-M	0 / 2287		
		M-L	0 / 2007		
		L-K	0 / 2481		
		K-J	0 / 2481		
		J-I	0 / 0		

TOTAL WEIGHT = 130 lb (M/F)

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.05")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
 ALLOWABLE DEFL.(TL) = L/360 (1.05")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.89/1.00 (G-H:1), BC=0.48/1.00 (J-L:1), WB=0.85/1.00 (G-L:1), SS=0.26/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN MAX MIN
MT20	618 354	1887 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (B) (INPUT = 0.90)
 JSI METAL= 0.76 (K) (INPUT = 1.00)




Structural component only
 DWG# T-2006852

JOB NAME 408320	TRUSS NAME T35	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 23 16:28:05 2020 Page 1
ID:7ILg53GdMK5ISQteanm7D6z[a3y-3RFXNizUwcCIEV6XtcqWHWizs9pHJrp7eUjwDNzNoEW
15-10-8 23-8-8 30-9-0 32-0-8
Scale = 1:51.5

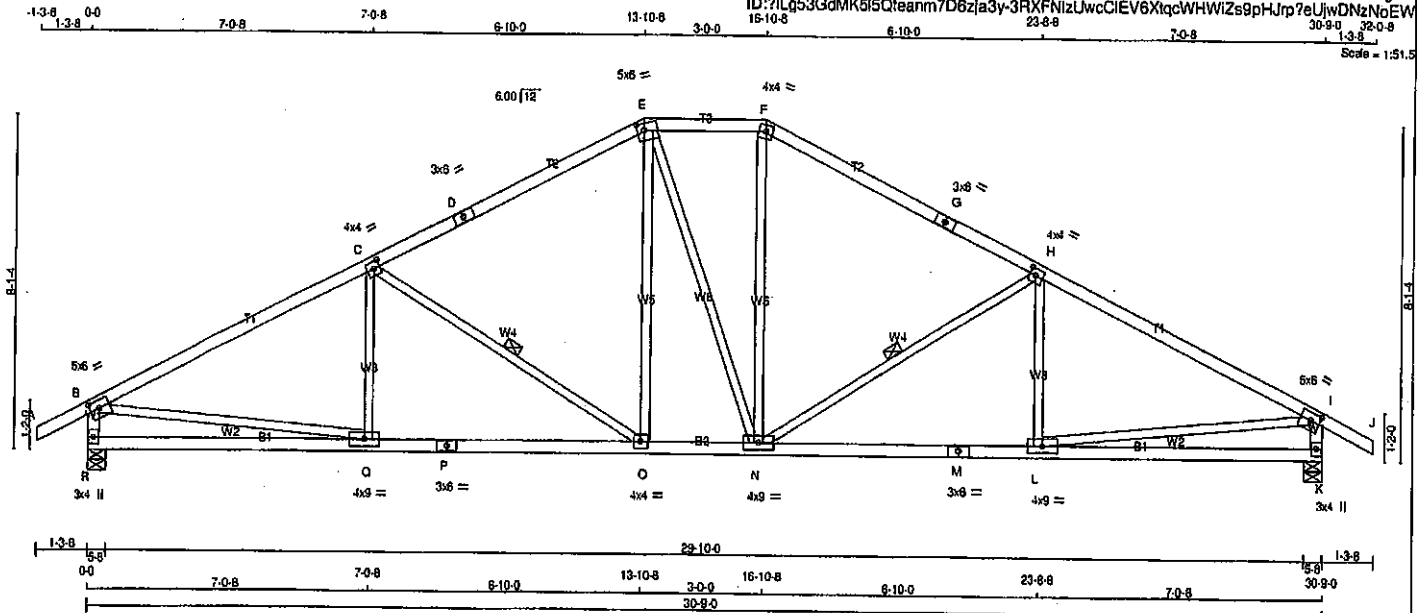

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY No.2	SPF
D - E	2x4	DRY No.2	SPF
E - F	2x4	DRY No.2	SPF
F - G	2x4	DRY No.2	SPF
G - J	2x4	DRY No.2	SPF
R - B	2x4	DRY No.2	SPF
K - I	2x4	DRY No.2	SPF
R - P	2x4	DRY No.2	SPF
P - M	2x4	DRY No.2	SPF
M - K	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMWW-I	MT20	5.0	0.0	2.25 2.75
C	TMWW-I	MT20	4.0	4.0	2.00 1.75
D	TS-I	MT20	3.0	6.0	
E	TTWW-m	MT20	5.0	8.0	2.00 2.00
F	TTW-m	MT20	4.0	4.0	
G	TS-I	MT20	3.0	6.0	
H	TMWW-I	MT20	4.0	4.0	2.00 1.75
I	TMWW-I	MT20	5.0	6.0	2.25 2.75
K	BMV-I+ap	MT20	3.0	4.0	
L	BMWW-I	MT20	4.0	9.0	
M	BS-I	MT20	3.0	6.0	
N	BMWW-I	MT20	4.0	9.0	
O	BMWW-I	MT20	4.0	4.0	
P	BS-I	MT20	3.0	6.0	
Q	BMWW-I	MT20	4.0	9.0	
R	BMV-I+ap	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG			
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
R	1820	0	1820	0	0	5-8	5-8
K	1820	0	1820	0	0	5-8	5-8
UNFACTORED REACTIONS							
JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS					
R	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	1284	856 / 0	0 / 0	0 / 0	0 / 0	428	0
K	1284	856 / 0	0 / 0	0 / 0	0 / 0	428	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS R, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.55 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-O, H-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO				FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	Q-C	-127.76	0.04 (1)	
B-C	-2472.0	-91.8	-91.8 0.78 (1)	C-D	-695.0	0.32 (1)	
C-D	-1884.0	-91.8	-91.8 0.68 (1)	D-E	0 / 452	0.10 (1)	
D-E	-1884.0	-91.8	-91.8 0.66 (1)	E-N	0 / 4	0.00 (1)	
E-F	-1661.0	-91.8	-91.8 0.14 (1)	N-F	0 / 456	0.10 (1)	
F-G	-1888.0	-91.8	-91.8 0.66 (1)	N-H	-693.0	0.32 (1)	
G-H	-1888.0	-91.8	-91.8 0.66 (1)	H-I	-129.75	0.04 (1)	
H-I	-2471.0	-91.8	-91.8 0.78 (1)	I-J	0 / 2258	0.51 (1)	
I-J	0 / 28	-91.8	-91.8 0.12 (1)	J-K	0 / 2257	0.51 (1)	
R-B	-1768.0	0.0	0.0 0.18 (1)				
K-I	-1765.0	0.0	0.0 0.18 (1)				
R-Q	0 / 0	-18.5	-18.5 0.22 (4)				
Q-P	0 / 2241	-18.5	-18.5 0.47 (1)				
P-O	0 / 2241	-18.5	-18.5 0.47 (1)				
O-N	0 / 1660	-18.5	-18.5 0.34 (1)				
N-M	0 / 2241	-18.5	-18.5 0.46 (1)				
M-L	0 / 2241	-18.5	-18.5 0.48 (1)				
L-K	0 / 0	-18.5	-18.5 0.22 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2018 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/999 (0.23")

CSI: TC=0.76/1.00 (B-C:1), BC=0.47/1.00 (O-Q:1), WB=0.51/1.00 (B-Q:1), SS=0.28/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PL)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.86 (B) (INPUT = 0.90)
JSI METAL= 0.69 (P) (INPUT = 1.00)



Structural component only
DWG# T-2006853

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408320	T35X	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					


Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 24 06:02:59 2020 Page 1
ID: 7Lg53GdMK5i5Qleanm7D62ja3y-B4CTSGGYSMadIYOQzm7vbwv5NMY_LfzC1GuWFzNaWA
13-8 0-0 7-0-8 7-0-8 6-10-0 13-10-8 30-0 16-10-8 6-10-0 23-8-8 7-0-8 30-8-0 32-0-8
Scale = 1:50.0

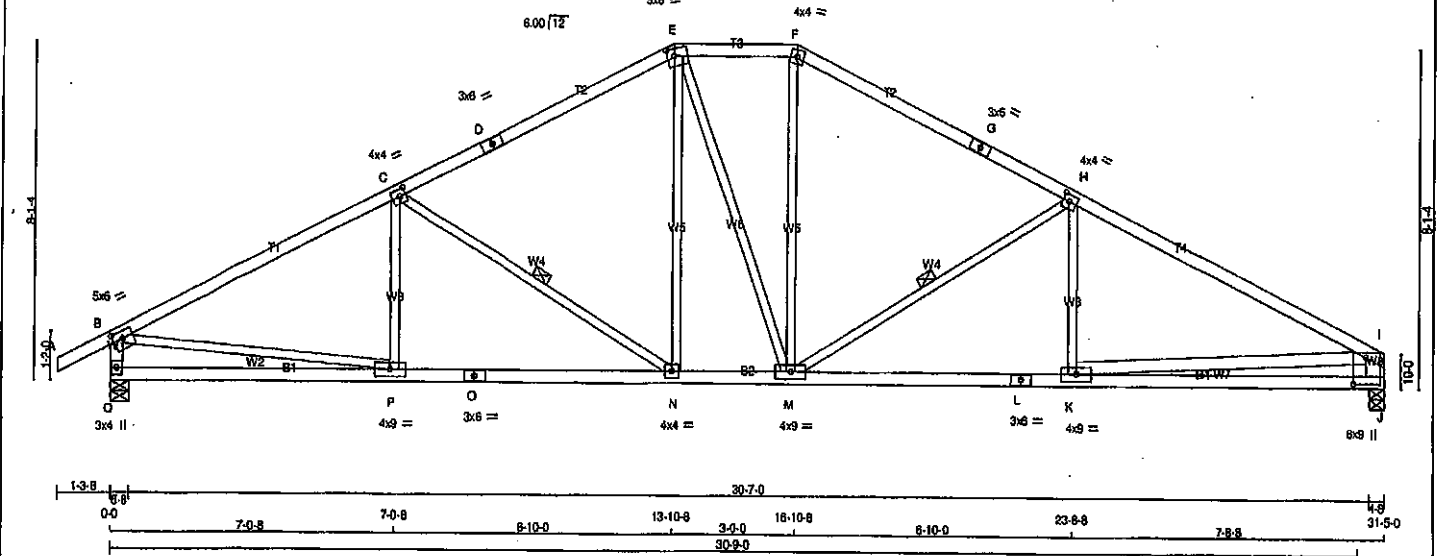

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
Q - B	2x4	DRY	No.2
J - I	2x6	DRY	No.2
Q - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
L - J	2x4	DRY	No.2
ALL WEBS EXCEPT K - I	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMWW-t	MT20	5.0	8.0	2.00 2.75
C TMWW-t	MT20	4.0	4.0	2.00 1.75
D TS-t	MT20	3.0	8.0	
E TTWW-m	MT20	5.0	6.0	2.00 2.00
F TTW-m	MT20	4.0	4.0	
G TS-t	MT20	3.0	6.0	
H TMWW-t	MT20	4.0	4.0	2.00 1.75
J				
J TMBMWV-t+pMT20		8.0	9.0	7.50 3.75
K BMWW-t	MT20	4.0	8.0	
L BS-t	MT20	3.0	8.0	
M BMWW-t	MT20	4.0	9.0	
N BMWW-t	MT20	4.0	4.0	
O BS-t	MT20	3.0	6.0	
P BMWW-t	MT20	4.0	9.0	
Q BMV-t	MT20	3.0	4.0	

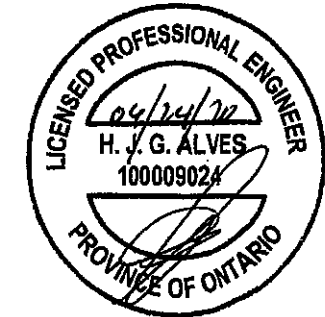

Structural component only
DWG# T-2008854

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	1858	1858	5-8	5-8
Q	HORZ	0	0	4-8	4-8
J	VERT	1732	1732	0	0

UNFACTORED REACTIONS		1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	Q	1310	873 / 0	0 / 0	0 / 0	0 / 0	437 / 0	0 / 0
Q	COMBINED	J	1225	804 / 0	0 / 0	0 / 0	0 / 0	421 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.14 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-N, H-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. UNBRACED LENGTH (FT)
FR-TO				FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	P-C	-135 / 73	0.04 (1)
B-C	-2538 / 0	-91.8	-91.8 0.77 (1)	8.50	Q-N	-887 / 0	0.31 (1)
C-D	-1858 / 0	-91.8	-91.8 0.67 (1)	4.02	N-E	0 / 450	0.10 (1)
D-E	-1858 / 0	-91.8	-91.8 0.67 (1)	4.02	E-M	0 / 41	0.01 (1)
E-F	-1739 / 0	-91.8	-91.8 0.14 (1)	4.94	M-F	0 / 504	0.11 (1)
F-G	-1977 / 0	-91.8	-91.8 0.73 (1)	3.88	M-H	-856 / 0	0.39 (1)
G-H	-1977 / 0	-91.8	-91.8 0.73 (1)	3.88	H-I	-14 / 121	0.04 (4)
H-I	-2712 / 0	-91.8	-91.8 0.98 (1)	3.14	B-P	0 / 2317	0.52 (1)
Q-B	-1802 / 0	0.0	0.0 0.18 (1)	6.23	K-I	0 / 2462	0.40 (1)
J-I	-1672 / 0	0.0	0.0 0.11 (1)	7.84			
Q-P	0 / 0	-18.5	-18.5 0.22 (4)	10.00			
P-O	0 / 2300	-18.5	-18.5 0.48 (1)	10.00			
O-N	0 / 2300	-18.5	-18.5 0.48 (1)	10.00			
N-M	0 / 1725	-18.5	-18.5 0.34 (1)	10.00			
M-L	0 / 2457	-18.5	-18.5 0.52 (1)	10.00			
L-K	0 / 2457	-18.5	-18.5 0.52 (1)	10.00			
K-J	0 / 0	-18.5	-18.5 0.25 (4)	10.00			

TOTAL WEIGHT = 131 lb (M/F)

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2:00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLES WITH:
- PART 8 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.05")
CALCULATED VERT. DEFL. (LL) = L/999 (0.12")
ALLOWABLE DEFL. (TL) = L/360 (1.05")
CALCULATED VERT. DEFL. (TL) = L/999 (0.24")

CSI: TC=0.98/1.00 (H-I:1), BC=0.52/1.00 (K-M:1), WB=0.52/1.00 (B-P:1), SSI=0.30/1.00 (H-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLJ)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.90 (F) (INPUT = 0.90)
JSI METAL=0.73 (L) (INPUT = 1.00)

MAX MIN MAX MIN MAX MIN
MT20 616 354 1887 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (I) (INPUT = 0.90)
JSI METAL = 0.82 (N) (INPUT = 1.00)

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
<u>BEARINGS</u>							
	FACTORED		MAXIMUM FACTORED		INPUT	REQ'D	
	GROSS	REACTION	GROSS	REACTION	BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
Q	1855	0	1855	0	0	5-8	5-8
K	1732	0	1732	0	0	5-8	5-8
<u>UNFACTORED REACTIONS</u>							
	1ST LCASE	MAX. MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT							
Q	1310	873 : 0	0 : 0	0 : 0	0 : 0	437 : 0	0 : 0
K	1225	804 : 0	0 : 0	0 : 0	0 : 0	421 : 0	0 : 0

ALL FITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-Q, I-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	
FR-TO				FR-TO			
A-B	0.28	-91.8	0.12 (1)	10.00	N-F	0.1224	
B-C	0.19	-91.8	0.30 (1)	10.00	N-H	-760.0	
C-D	-2390.0	-91.8	0.34 (1)	4.16	H-L	0.1446	
D-E	-1809.0	-91.8	0.31 (1)	4.68	L-I	-309.0	
E-F	-1809.0	-91.8	0.31 (1)	4.68	C-N	-685.0	

TOTAL WEIGHT = 8 X 129 = 1032

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL	LD	=	39.0	PSF

SPACING = 24.0 IN.C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ASBC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L PLUS 8.4 P.S.F. RAIN LOAD) EQUIALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.05")
CALCULATED VERT. DEFL.(LL) = U/999 (0.12")
ALLOWABLE DEFL.(TL)= L/360 (1.05")
CALCULATED VERT. DEFL.(TL) = U/999 (0.25")

CS#: TC=0.39/1.00 (H-H), BC=0.55/1.00 (K-L:1), WB=0.89/1.00 (H-N:1), SSI=0.22/1.00 (I-J:1)

DOL LENGTH=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(ORY)	SHEAR (PSI)	SECTION (PLI)
	MAX MIN	MAX MIN
MT20	618 354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (C) (INPUT = 0.90)
JSI METAL= 0.88 (M) (INPUT = 1.00)




[illegible]

Structural component only
DWG# T-2006858

JOB NAME 408320	TRUSS NAME T38Z	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 23 16:26:11 2020 Page 1
ID: 7iLg53GdMK5i5Qteanm7D6zia3y-ubvWdo2FWSyuyQZhE4jwXnxhZawKib7i0QAER0zNoEO

Scale = 1:20.1

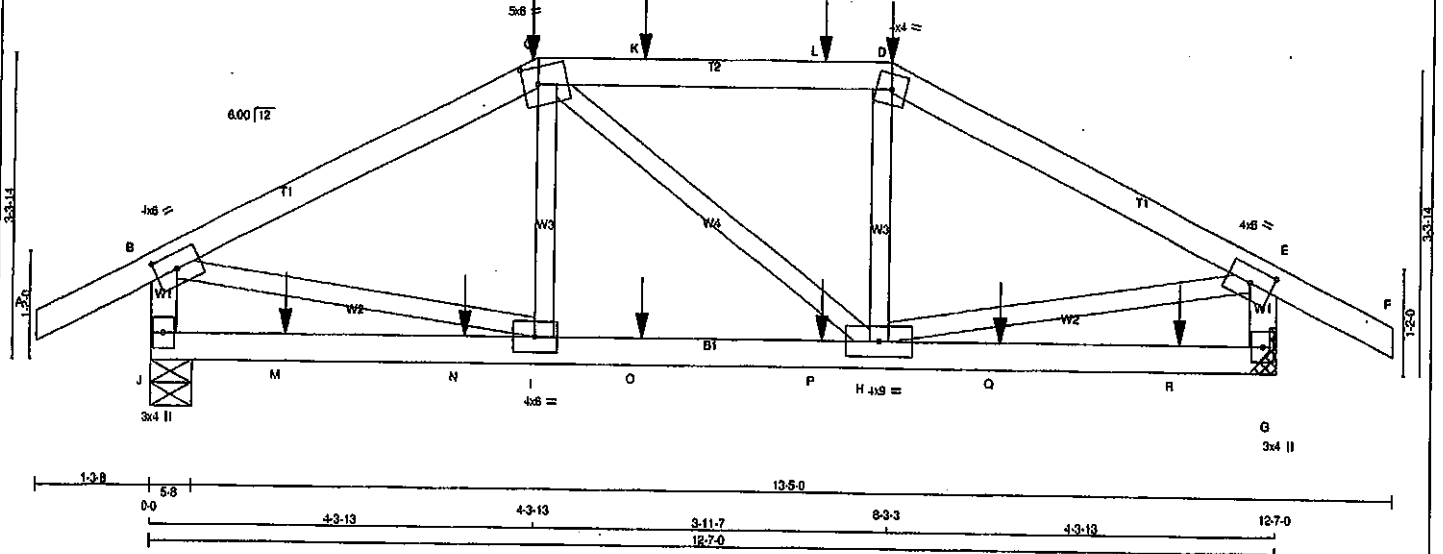

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
J - B	2x4	DRY	No.2	SPF
G - E	2x4	DRY	No.2	SPF
J - G	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	8.0	2.00	3.00
C	TTWW-m	MT20	5.0	6.0	2.25	2.00
D	TTWW-m	MT20	4.0	4.0		
E	TMVW-1	MT20	4.0	6.0	2.00	3.00
G	BMV1+p	MT20	3.0	4.0		
H	BMVWW-1	MT20	4.0	9.0		
I	BMVWW-1	MT20	4.0	6.0		
J	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED		MAXIMUM FACTORED		INPUT	REQRD
	GROSS REACTION		GROSS REACTION		BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
J	1108	0	1108	0	0	5-8
G	1118	0	1118	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	780	531.0	0.0	0.0	0.0	249.0	0.0
G	788	534.0	0.0	0.0	0.0	252.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.33 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	LC1 MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0.28	-91.8	-91.8 0.13 (1)	10.00	I-C	-101.53	0.02 (1)
B-C	-1191.0	-91.8	-91.8 0.38 (1)	5.38	C-H	0.12	0.00 (1)
C-K	-1070.0	-91.8	-91.8 0.38 (1)	5.58	H-D	-105.54	0.02 (1)
K-L	-1070.0	-91.8	-91.8 0.38 (1)	5.58	B-I	0.1085	0.27 (1)
L-D	-1070.0	-91.8	-91.8 0.38 (1)	5.58	H-E	0.1098	0.27 (1)
D-E	-1205.0	-91.8	-91.8 0.38 (1)	5.33			
E-F	0.28	-91.8	-91.8 0.13 (1)	10.00			
F-B	-1084.0	0.0	0.0 0.12 (1)	7.61			
G-E	-1058.0	0.0	0.0 0.12 (1)	7.60			
J-M	0.0	-18.5	-18.5 0.11 (4)	10.00			
M-N	0.0	-18.5	-18.5 0.11 (4)	10.00			
N-I	0.0	-18.5	-18.5 0.11 (4)	10.00			
I-O	0.1061	-18.5	-18.5 0.23 (1)	10.00			
O-P	0.1061	-18.5	-18.5 0.23 (1)	10.00			
P-H	0.1061	-18.5	-18.5 0.23 (1)	10.00			
H-Q	0.0	-18.5	-18.5 0.11 (4)	10.00			
Q-R	0.0	-18.5	-18.5 0.11 (4)	10.00			
R-G	0.0	-18.5	-18.5 0.11 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	4-3-13	-38	-42	---	FRONT	VERT	DEAD	C1
C	4-3-13	-173	-173	---	FRONT	VERT	SNOW	C1
D	8-3-3	-38	-42	---	FRONT	VERT	DEAD	C1
D	8-3-3	-173	-173	---	FRONT	VERT	SNOW	C1
K	5-6-4	-42	-42	---	FRONT	VERT	TOTAL	C1
L	7-8-4	-53	-53	---	FRONT	VERT	TOTAL	C1
M	1-6-4	-12	-12	---	FRONT	VERT	TOTAL	C1
N	3-6-4	-12	-12	---	FRONT	VERT	TOTAL	C1
O	5-6-4	-12	-12	---	FRONT	VERT	TOTAL	C1
P	7-8-4	-12	-12	---	FRONT	VERT	TOTAL	C1
Q	9-8-4	-12	-12	---	FRONT	VERT	TOTAL	C1
R	11-6-4	-12	-12	---	FRONT	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 089-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.42")
CALCULATED VERT. DEFL.(LL) = L/989 (0.02")
ALLOWABLE DEFL.(TL) = L/380 (0.42")
CALCULATED VERT. DEFL.(TL) = L/989 (0.04")

CSI: TC=0.36/1.00 (C-D:1), BC=0.23/1.00 (H-I:1), WB=0.27/1.00 (E-H:1), SS=0.20/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00


COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.70 (I) (INPUT = 0.80)
JSI METAL= 0.34 (E) (INPUT = 1.00)

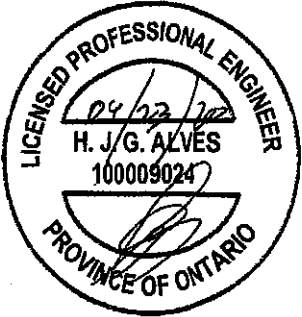

Structural component only
DWG# T-2006859

JOB NAME 408318	TRUSS NAME PB1	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	
Version 8.310 8 Oct 29 2019 MTEK Industries, Inc. Thu Apr 23 15:32:45 2020 Page 1					
ID: HJ7_mBNWkyCmBzl_hTT?DUzjdZA-mpBwmZEEEXP1nKKTQmC6b9p2DwYhy_odYbvrzNp0VW					
Scale = 1:16.8					

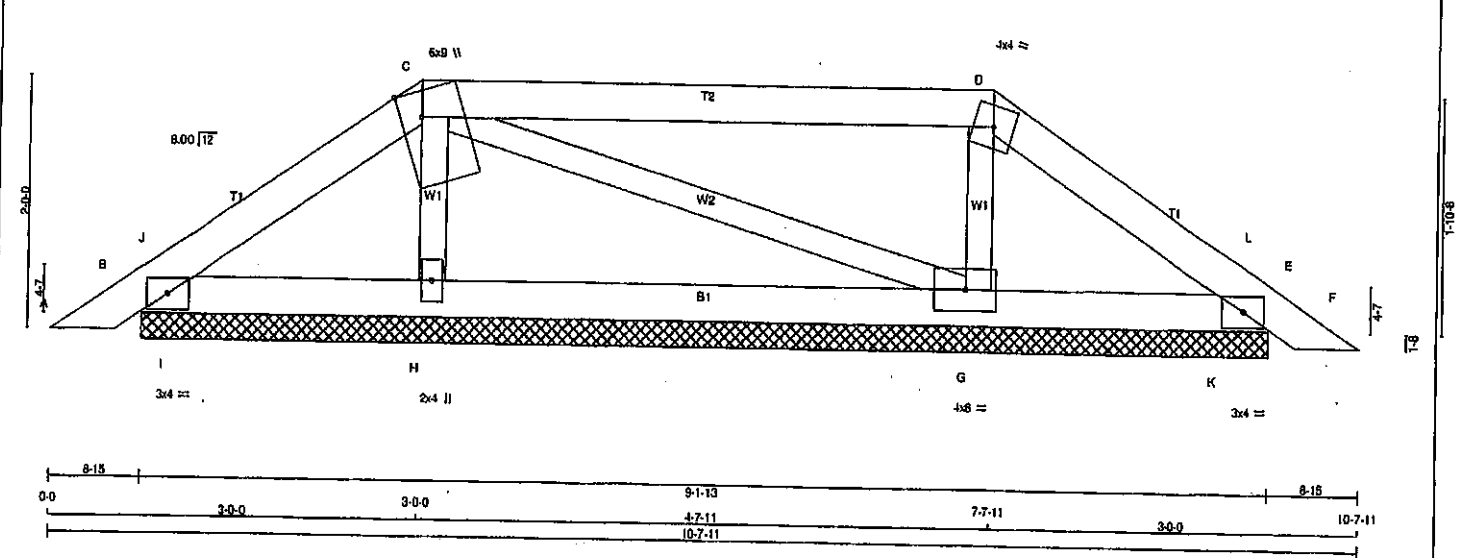

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				TOTAL WEIGHT = 2 X 30 = 59 lb			
N. L. G. A. RULES	SIZE	DRY	LUMBER	DESCR.	SPF	FACTORED	MAXIMUM FACTORED	INPUT	RECORD	DESIGN CRITERIA	
CHORDS	2x4	DRY	No.2	SPF	SPF	GROSS REACTION	GROSS REACTION	BRG	BRG	SPECIFIED LOADS:	
A - C	2x4	DRY	No.2	SPF	SPF	VERT	DOWN	IN-SX	IN-SX	TOP CH. LL	25.6 PSF
C - D	2x4	DRY	No.2	SPF	SPF	HORZ	HORZ	UPLIFT	UPLIFT	DL	6.0 PSF
D - F	2x4	DRY	No.2	SPF	SPF					BOT CH. LL	6.0 PSF
F - E	2x4	DRY	No.2	SPF	SPF					DL	7.4 PSF
ALL WEBS	2x3	DRY	No.2	SPF	SPF					TOTAL LOAD	39.0 PSF
DRY, SEASONED LUMBER.										SPACING	24.0 IN. OC

PLATES (table in inches)				UNFACTORED REACTIONS				DESIGN CRITERIA			
JT	TYPE	PLATES	W LEN Y X	JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	TMB1-I	MT20	3.0 4.0	E	151	115.0	0.0	0.0	0.0	36.0	0.0
C	TTWW+m	MT20	6.0 9.0 Edge 2.00	H	144	110.0	0.0	0.0	0.0	34.0	0.0
D	TTW-m	MT20	4.0 4.0	G	244	150.0	0.0	0.0	0.0	94.0	0.0
E	TMB1-I	MT20	3.0 4.0		258	161.0	0.0	0.0	0.0	97.0	0.0
G	BMWW1-I	MT20	4.0 6.0								
H	BMW1+V	MT20	2.0 4.0								

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING				CHORDS				WEBS			
TOTAL LOAD CASES: (4)				MAX. FACTORED				MAX. FACTORED			
				FORCE (LBS)				FORCE (LBS)			
				VERT. LOAD LC1 MAX				MAX. FACTORED			
				FROM TO				LENGTH FR-TO			
				FR-TO				MEMB. MAX. FACTORED			
				A-B				H-C			
				B-J				C-G			
				J-C				G-D			
				C-D				I-J			
				D-L				K-L			
				L-E							
				E-F							
				B-I							
				I-H							
				H-G							
				G-K							
				K-E							

CS: TC=0.34/1.00 (C-D:1), BC=0.07/1.00 (H-I:4), WB=0.04/1.00 (D-G:1), SSI=0.17/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.18 (B) (INPUT = 0.90)

JSI METAL = 0.05 (H) (INPUT = 1.00)

LICENSED PROFESSIONAL ENGINEER
H. J. G. ALVES
100009024
PROVINCE OF ONTARIO

Structural component only
DWG# T-2006815

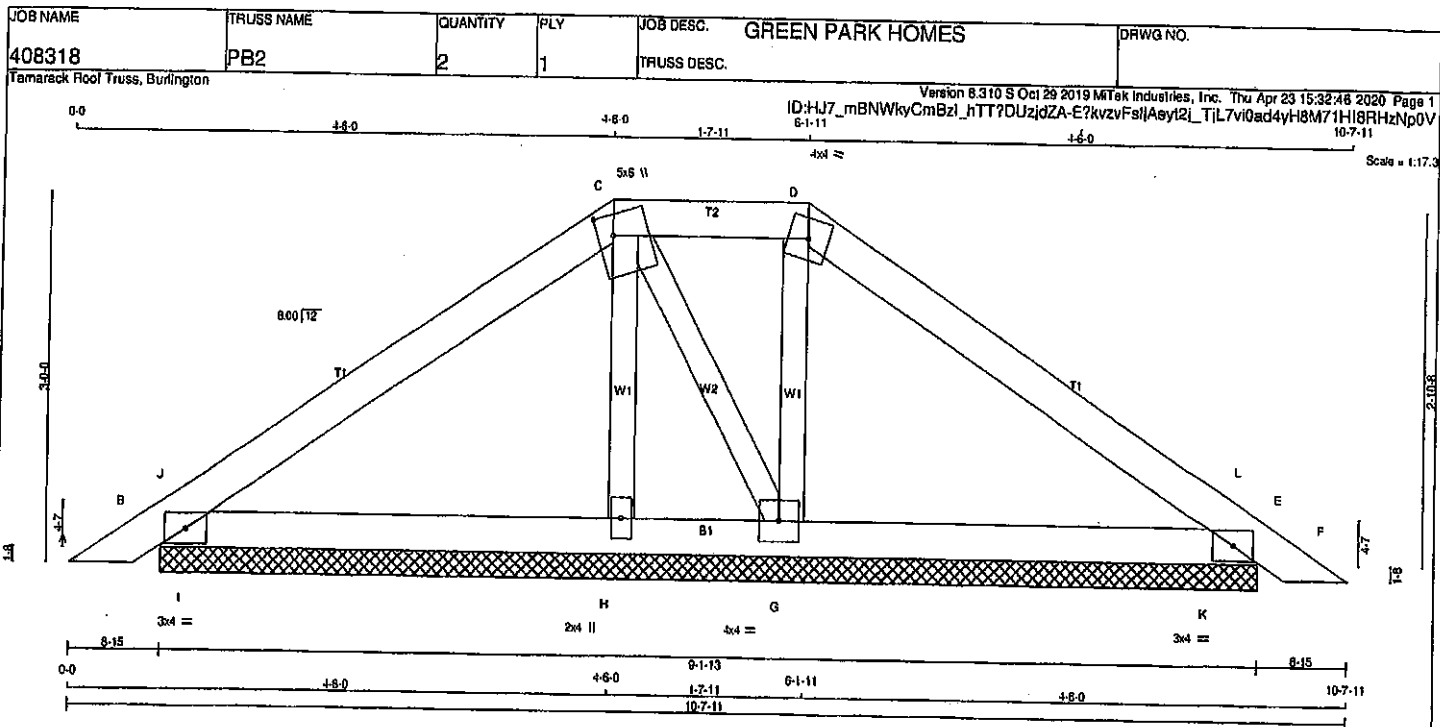

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF
C - D	2x4 DRY	No.2	SPF
D - F	2x4 DRY	No.2	SPF
B - E	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
DRY: SEASONED LUMBER.			

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-J	MT20	3.0	4.0		
C	TTWW+m	MT20	5.0	6.0	2.00	1.50
D	TTW-m	MT20	4.0	4.0		
E	TMB1-J	MT20	3.0	4.0		
G	BMWW1-i	MT20	4.0	4.0		
H	BMWW1-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
B	328	0	328	0	9-1-13	9-1-13
E	312	0	312	0	9-1-13	9-1-13
H	192	0	192	0	9-1-13	9-1-13
G	299	0	299	0	9-1-13	9-1-13

UNFACTORED REACTIONS

JT	1ST CASE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
B	230	183.0	0.0	0.0	0.0	67.0	0.0
E	219	153.0	0.0	0.0	0.0	65.0	0.0
H	138	90.0	0.0	0.0	0.0	58.0	0.0
G	211	140.0	0.0	0.0	0.0	71.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LBS)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LBS)	
FR-TO		FROM TO			FR-TO			
A-B	0.15	-91.8	-91.8	0.03 (1)	10.00	H-C	-105.0	0.02 (1)
B-J	-48.0	-91.8	-91.8	0.06 (1)	6.25	C-G	-52.0	0.01 (1)
J-C	-135.0	-91.8	-91.8	0.16 (1)	6.25	G-D	-166.0	0.03 (1)
C-D	-75.0	-91.8	-91.8	0.04 (1)	6.25	I-J	-309.0	0.00 (1)
D-L	-108.0	-91.8	-91.8	0.16 (1)	6.25	K-L	-312.0	0.00 (1)
L-E	-38.0	-91.8	-91.8	0.06 (1)	6.25			
E-F	0.15	-91.8	-91.8	0.03 (1)	10.00			
B-I	0.106	-18.5	-18.5	0.14 (1)	10.00			
I-H	0.106	-18.5	-18.5	0.14 (1)	10.00			
H-G	0.102	-18.5	-18.5	0.09 (1)	10.00			
G-K	0.82	-18.5	-18.5	0.14 (1)	10.00			
K-E	0.82	-18.5	-18.5	0.14 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.16/1.00 (C-J:1), BC=0.14/1.00 (H-I:1), WB=0.03/1.00 (D-G:1), SS=0.24/1.00 (E-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PLI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.27 (B) (INPUT = 0.80)
JSI METAL = 0.07 (B) (INPUT = 1.00)

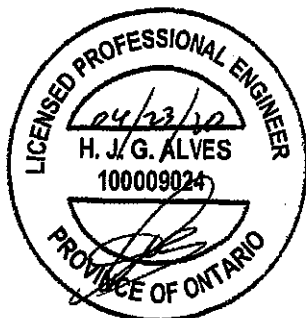

Structural component only
DWG# T-2006816

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408318	PB3	3	1	GREEN PARK HOMES	
Tamsack Roof Truss, Burlington					
Version 8.310 8 Oct 29 2019 MITek Industries, Inc. Thu Apr 23 15:32:48 2020 Page 1					
ID:HJ7_m8NWkyCmBzl_hTT?DUzldZA-AOslObH6qKQMBBC55ulpDKnLxRkDl2pQUbnFWAznP0T					
10-7-11					
Scale = 1:20.5					

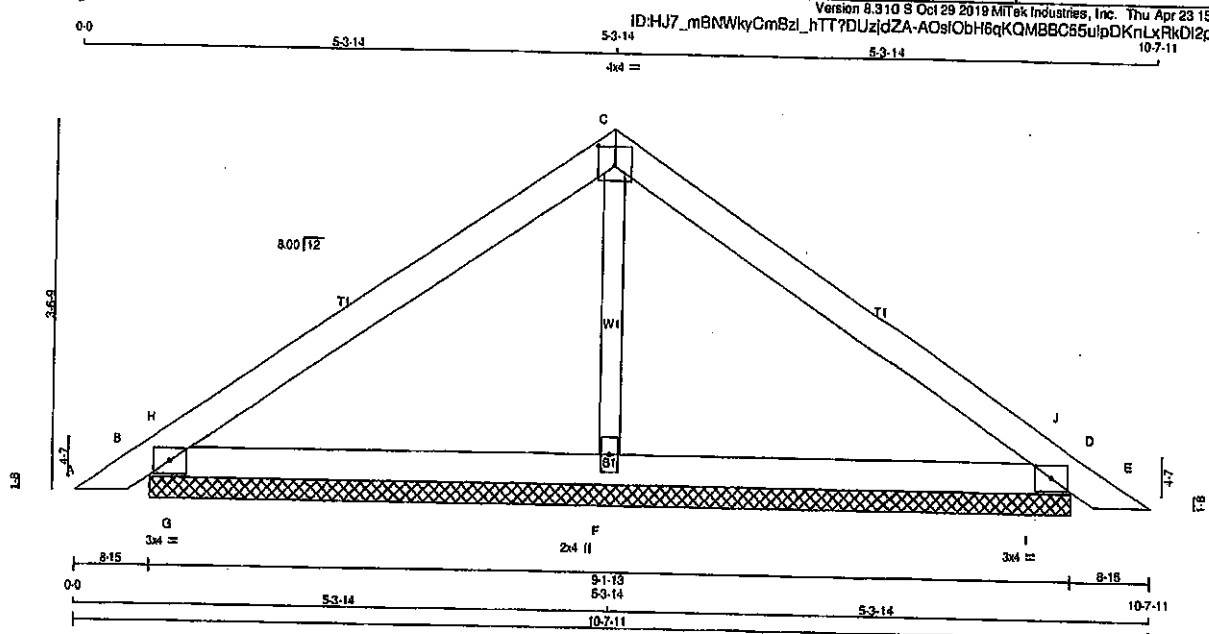

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - E	2x4	DRY	No.2	SPF		
B - D	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
DRY: SEASONED LUMBER.						

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-i	MT20	3.0	4.0		
C	TTW-p	MT20	4.0	4.0	2.25	2.00
D	TMB1-i	MT20	3.0	4.0		
F	BMW1-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
B	382	0	382	0	9-1-13	9-1-13
D	382	0	382	0	9-1-13	9-1-13
F	387	0	387	0	9-1-13	9-1-13

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	268	191.0	0.0	0.0	0.0	77.0	0.0
D	268	191.0	0.0	0.0	0.0	77.0	0.0
F	262	155.0	0.0	0.0	0.0	107.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		MAX. UNBRACED LENGTH	MEMB.	WEBS	
	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	CS1 (LC)	CS1 (LC)			MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO						
A-B	0 / 15	-91.8 -91.8	0.03 (1)	10.00	F-C	-162 / 0	0.03 (1)	
B-H	-38 / 0	-91.8 -91.8	0.12 (1)	8.25	G-H	-496 / 0	0.00 (1)	
H-C	-182 / 0	-91.8 -91.8	0.23 (1)	6.25	I-J	-496 / 0	0.00 (1)	
C-J	-182 / 0	-91.8 -91.8	0.23 (1)	6.25				
J-D	-38 / 0	-91.8 -91.8	0.12 (1)	6.25				
D-E	0 / 15	-91.8 -91.8	0.03 (1)	10.00				
B-G	0 / 142	-18.5 -18.5	0.22 (1)	10.00				
G-F	0 / 142	-18.5 -18.5	0.22 (1)	10.00				
F-I	0 / 142	-18.5 -18.5	0.22 (1)	10.00				
I-D	0 / 142	-18.5 -18.5	0.22 (1)	10.00				

TOTAL WEIGHT = 3 X 27 = 82 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 8.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(58 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS1: TC=0.23/1.00 (C-J:1), BC=0.22/1.00 (F-I:1), WB=0.03/1.00 (C-F:1), SS=0.37/1.00 (B-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MT20	618	354	1867
	788	1867	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.34 (D) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)

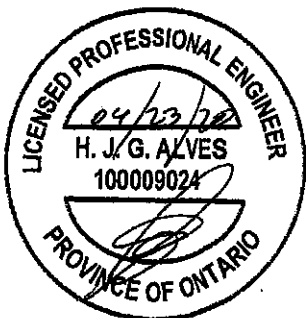

Structural component only
DWG# T-2006817

JOB NAME 408318	TRUSS NAME J1	QUANTITY 8	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 23 15:32:43 2020 Page 1
ID:HJ7_mBNWkyCmBzl_hTT?DUzjdZA-pQ3mLID_7on45QJ8ILAeWH4QNQ2R4n3hLJ3UzzNp0Y

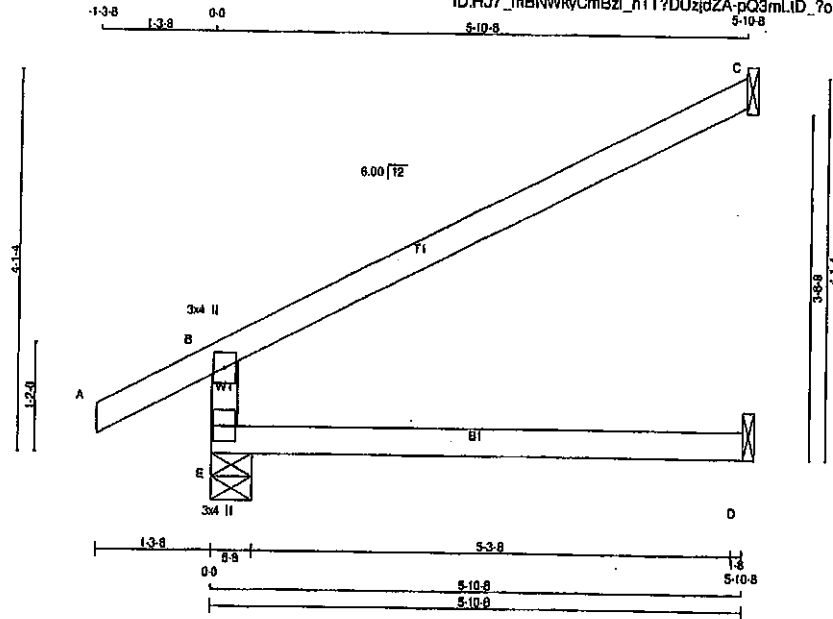

Scale = 1:22.9

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2	
A - C	2x4	DRY	No.2	
E - D	2x4	DRY	No.2	

DRY: SEASONED LUMBER.

PLATES (tablets in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REORD BRG
	VERT	HORZ	DOWN	HORZ		
E	525	0	525	0	5-8	5-8
C	202	0	202	0	1-8	1-8
D	45	0	50	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOASE	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	369	257.0	0.0	0.0	0.0	111.0	0.0
C	139	113.0	0.0	0.0	0.0	26.0	0.0
D	36	0.0	0.0	0.0	0.0	36.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD	LC1 (PLF)	MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB. FR-TO	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
		FROM	TO						
E-B	-461.0	0.0	0.0	0.13 (4)	7.81				
A-B	0.28	-91.8	-91.8	0.12 (1)	10.00				
B-C	-30.0	-91.8	-91.8	0.54 (1)	6.25				
E-D	0.0	-18.5	-18.5	0.13 (4)	10.00				

TOTAL WEIGHT = 8 X 17 = 134 b

DESIGN CRITERIA

SPECIFIED LOADS:		
TOP CH.	LL = 25.8	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN LC/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.03")

CSI: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (A:0), SS=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)		SHEAR	SECTION	
	(PSI)		(PLI)	(PLI)	
	MAX	MIN	MAX	MIN	MAX
MT20	618	354	1667	788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.19 (E) (INPUT = 0.90)
JSI METAL= 0.13 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006813

JOB NAME 408318	TRUSS NAME J2	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.3.10 S Ocl 29 2018 Mitek Industries, Inc. Thu Apr 23 15:32:44 2020 Page 1
ID:HJ7_m8NWkyCmBzl_hTT?DUzjdZA-Hcd8YDEcm5vwjauKs3hi2UdqupPRpEjZzp2NPzNp0X
Scale = 1:20.3

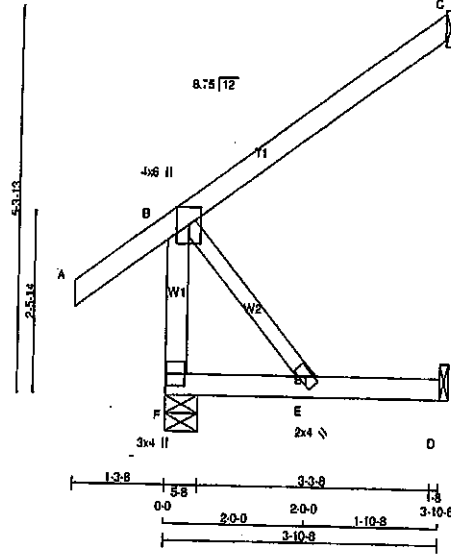

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	8.0	Edge
E	BMV+w	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	HORZ	BRG	IN-SX	BRG	IN-SX
F	340	0	340	0	0	5-8	5-8	5-8	5-8
C	178	0	178	0	0	1-8	1-8	1-8	1-8
D	38	0	40	0	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST LCASE		MAX./MIN. COMPONENT REACTIONS		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	SNOW	LIVE	SNOW	LIVE	SNOW	LIVE	SNOW	LIVE	SNOW	LIVE
F	238	170.0	0.0	0.0	0.0	0.0	0.0	68.0	0.0	0.0	0.0	0.0	0.0
C	122	99.0	0.0	0.0	0.0	0.0	0.0	23.0	0.0	0.0	0.0	0.0	0.0
D	29	0.0	0.0	0.0	0.0	0.0	0.0	29.0	0.0	0.0	0.0	0.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		MAX. FACTORED		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT.	LOAD (PLF)	LC1	MAX	MEMB.	FORCE (LBS)	MAX	CS1 (LC)
FR-TO						FR-TO			
F-B	-304.0	0.0	0.0	0.04 (1)	7.81	B-E	0.0	0.00 (1)	
A-B	0.37	-91.8	-91.8	0.14 (5)	10.00				
B-C	0.0	-91.8	-91.8	0.23 (1)	10.00				
F-E	0.0	-18.5	-18.5	0.08 (4)	10.00				
E-D	0.0	-18.5	-18.5	0.08 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 5 X 17 = 99 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
OL = 8.0 PSF
BOT CH. LL = 0.0 PSF
OL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CS1: TC=0.23/1.00 (B-C:1), 8C=0.08/1.00 (E-F:4), WB=0.00/1.00 (B-E:1), SS1=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.18 (B) (INPUT = 0.80)
JSI METAL = 0.08 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006814

JOB NAME 408319	TRUSS NAME J21	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 28 2019 Mitek Industries, Inc. Thu Apr 23 15:38:29 2020 Page 1
ID: 5VQZIPiKewF0JO1uJiWFAzjccR-CvjCn9yknEG7C9baYpDdgrR66WC4177yJUpSnszNoz0

Scale = 1:29.3

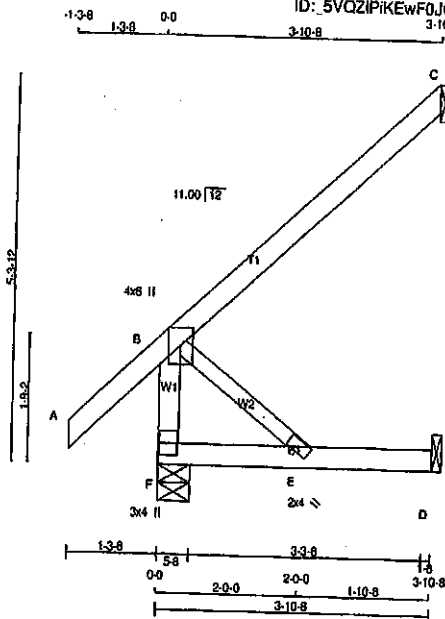

LUMBER	N.L.G.A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF		
A - C	2x4	DRY	No.2	SPF		
F - D	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
DRY: SEASONED LUMBER.						

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	8.0	Edge	
E	BMVW+p	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
F	341	0	341	0	0	5-8	5-8
C	178	0	178	0	0	1-8	1-8
D	38	0	40	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	239	170.0	0.0	0.0	0.0	69.0	0.0
C	122	99.0	0.0	0.0	0.0	23.0	0.0
D	29	0.0	0.0	0.0	0.0	29.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED	FACTORED	FACTORED	WEBS	MAX. FACTORED	FACTORED	FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	FACTORED
FR-TO		FROM TO	LENGTH	FR-TO			
F-B	-305.0	0.0	0.0 0.03 (1)	7.81	B-E	0.0	0.00 (1)
A-B	0.43	-91.8	-91.8 0.14 (5)	10.00			
B-C	0.0	-91.8	-91.8 0.23 (1)	10.00			
F-E	0.0	-18.5	-18.5 0.08 (4)	10.00			
E-D	0.0	-18.5	-18.5 0.08 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 8 X 16 = 97 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	8.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.01")

CSI: TC=0.23/1.00 (B-C:1), BC=0.08/1.00 (E-F:4),
WB=0.00/1.00 (B-E:1), SSI=0.10/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1687	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.22 (B) (INPUT = 0.90)
JSI METAL = 0.08 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006833

JOB NAME 408319	TRUSS NAME J22	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 23 15:38:30 2020 Page 1
ID: 5VQZIPKEwF0JO1uJWFAzjccR-g5Ha_VzNYXOsqJAm5WksCB_FawWnmSF8X7Z?JuzNoz?

Scale = 1:13.1

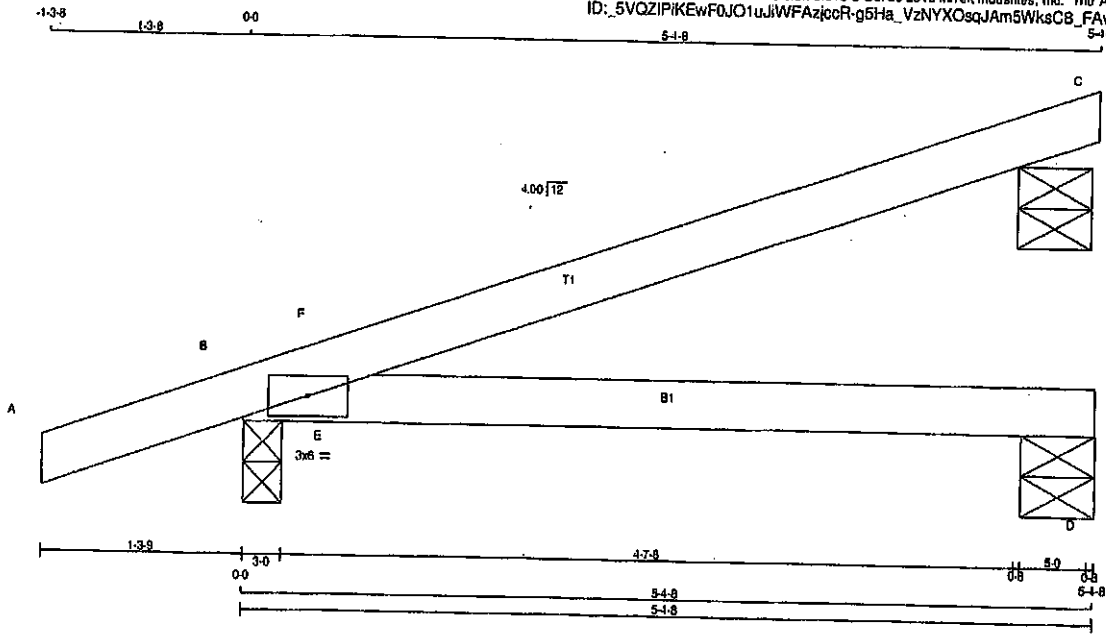

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS	2x4	DRY	No.2
A - C	2x4	DRY	No.2
B - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)			
JT TYPE	PLATES	W	LEN Y X
B	TMB1-1	MT20	3.0 6.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	IN-SX
C	215	0	215	0	0	0	0	5-8	5-8
B	419	0	419	0	0	0	0	3-0	3-0
D	81	0	81	0	0	0	0	5-8 (5-7)	5-8

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
C	149	116 / 0	0 / 0	0 / 0	0 / 0	33 / 0	0 / 0
B	294	206 / 0	0 / 0	0 / 0	0 / 0	88 / 0	0 / 0
D	81	22 / 0	0 / 0	0 / 0	0 / 0	39 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LG1 MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LG1 MAX. CS1 (LC)
FR-TO				FR-TO			
A-B	0 / 18	-91.8	-91.8 0.11 (1)	E-F	-280	11	0.00 (1)
B-F	-18.10	-91.8	-91.8 0.08 (4)				
F-C	-1 / 2	-91.8	-91.8 0.34 (1)				
B-E	0 / 0	-18.5	-18.5 0.24 (1)				
E-D	0 / 0	-18.5	-18.5 0.24 (1)				

TOTAL WEIGHT = 6 X 14 = 86 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/634 (0.10")

CSI: TC=0.34/1.00 (C-F:1), BC=0.24/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SS=0.23/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.18 (B) (INPUT = 0.30)
JSI METAL = 0.05 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006834

JOB NAME 408320	TRUSS NAME J31	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 5 Oct 29 2019 MTEK Industries, Inc. Thu Apr 23 16:25:51 2020 Page 1 ID:7fLg53GdMK5i5Qteanm7D6zja3y-TkhzRzoiDIRkZL1r3tMEJZ6JEW8H1chXQJKBkzNoEk 5-10-8			

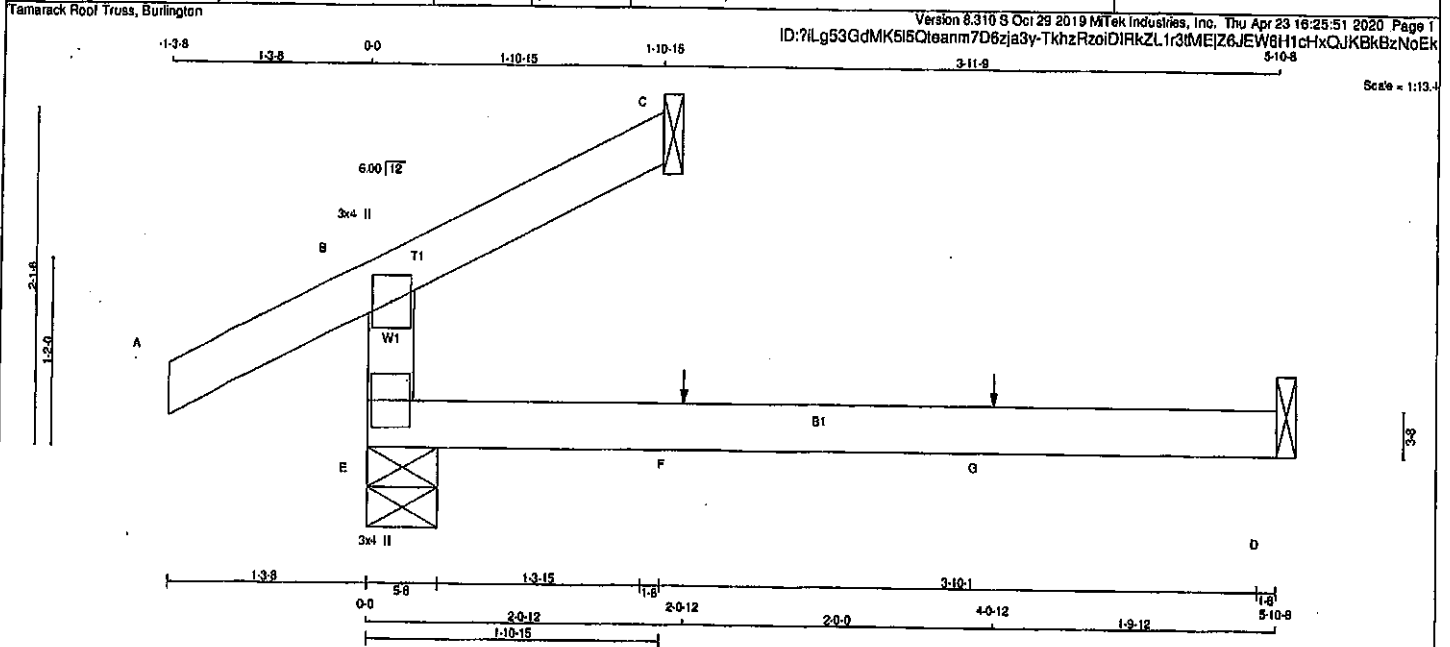

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
E	297	297	5-8	5-8
C	68	68	1-8	1-8
D	45	50	1-8	1-8

SEE MTEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) E, C

UNFACTORED REACTIONS

JT	1ST LOASE	MAX MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	212	130.0	0.0	0.0	0.0	0.0	82.0	0.0
C	48	37.0	0.0	0.0	0.0	0.0	9.0	0.0
D	35	0.0	0.0	0.0	0.0	0.0	38.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX: UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	MEMB.
FR-TO				FR-TO			
E-B	-234.0	0.0	0.0 (13 (4))	7.81			
A-B	0.28	-91.8	-91.8 (12 (1))	10.00			
B-C	-10.0	-91.8	-91.8 (0.06 (1))	10.00			
E-F	0.0	-18.5	-18.5 (13 (4))	10.00			
F-G	0.0	-18.5	-18.5 (13 (4))	10.00			
G-D	0.0	-18.5	-18.5 (13 (4))	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	2-0-12	1	1	---	FRONT	VERT	TOTAL	---	C1
G	4-0-12	1	1	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.03")

CSI: TC=0.13/1.00 (B-E/4), BC=0.13/1.00 (D-E/4), WB=0.00/1.00 (n/a:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=0.99 NAIL=0.99 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 768 1987 1656

PLATE PLACEMENT TOL = 5.0 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006841

JOB NAME 408320	TRUSS NAME J32	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 23 16:25:52 2020 Page 1	

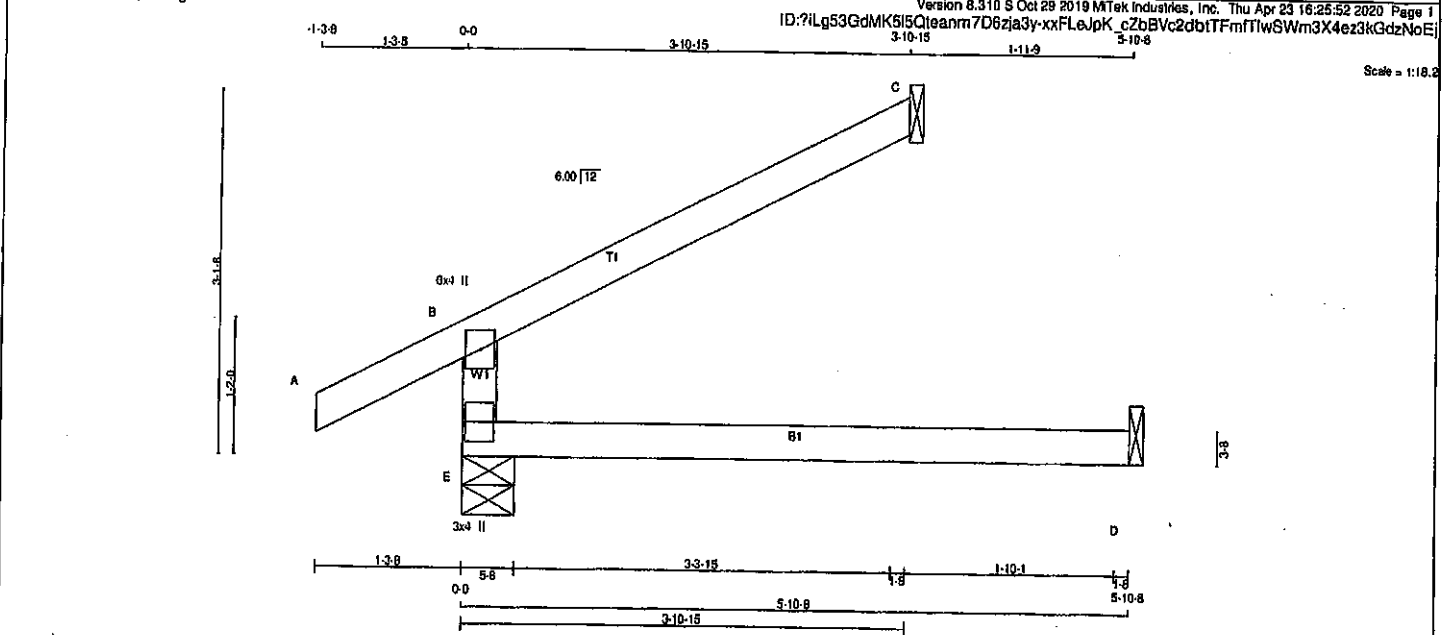

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (Table in inches)				
JT TYPE	PLATES	W	LEN	Y
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
E	412	0	412	0	5-8	5-8
C	135	0	135	0	1-8	1-8
D	45	0	50	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	291	194 / 0	0 / 0	0 / 0	0 / 0	97 / 0	0 / 0
C	93	75 / 0	0 / 0	0 / 0	0 / 0	18 / 0	0 / 0
D	36	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH FR-TO	MAX. FACTORED CSI (LC)
FR-TO		FROM TO		FR-TO			
E - B	-349 / 0	0.0	0.0 0.13 (4)	7.81			
A - B	0 / 28	-91.8	-91.8 0.12 (1)	10.00			
B - C	-20 / 0	-91.8	-91.8 0.24 (1)	8.25			
E - D	0 / 0	-18.5	-18.5 0.13 (4)	10.00			

TOTAL WEIGHT = 4 X 14 = 57 lbs

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCG 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.24/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (A:0), SSI=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.15 (E) (INPUT = 0.90)
JSI METAL= 0.10 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006842

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408320	J34	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 23 16:25:54 2020 Page 1
ID:7ILg53GdMK5i5Qteanm7D6zja3y-uJN53_qaWDpJQpmQk0wxLBkpoJAEz0N6GYrKVzNoEH

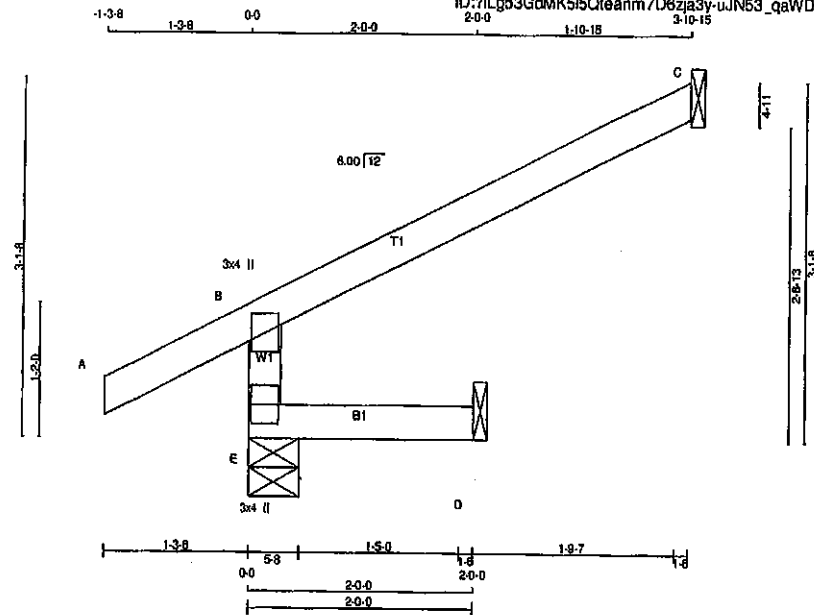

TOTAL WEIGHT = 4 X 10 = 39 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - 8	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX		REQD BRG IN-SX	
	VERT	HORZ	DOWN	HORZ	UPLIFT	BRG	BRG	IN-SX
E	389	0	369	0	0	5-8	5-8	
C	135	0	135	0	0	1-8	1-8	
D	18	0	18	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	COMBINED	MAX/MIN COMPONENT REACTIONS					
		1ST CASE	SNOW	LIVE	PERM LIVE	WIND	DEAD
E	256	194 / 0	0 / 0	0 / 0	0 / 0	0 / 0	62 / 0
C	93	75 / 0	0 / 0	0 / 0	0 / 0	0 / 0	18 / 0
D	13	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	13 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LOAD (LC1)	MAX. UNBRACED LENGTH	MEMB. FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO						
E-B	-349 / 0	0.0	0.0	0.01 (4)	7.81	
A-B	0 / 28	-91.8	-91.8	0.13 (5)	10.00	
B-C	-20 / 0	-91.8	-91.8	0.24 (1)	6.25	
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2019, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.24/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX MIN
MT20	618	354	1607 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.15 (E) (INPUT = 0.90)
JSI METAL= 0.10 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006844

JOB NAME 408320	TRUSS NAME J36	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

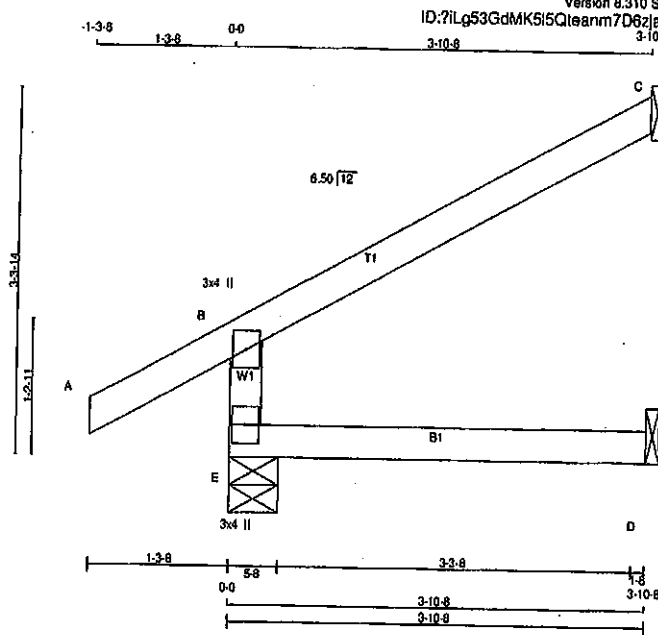

Scale = 1:10.0

CHORDS	SIZE	DRY	NO.2
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGSS		FACTORED		MAXIMUM FACTORED		INPUT	REQD
		GROSS REACTION		GROSS REACTION		BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	388	0	388	0	0	5-8	5-8
C	133	0	133	0	0	1-8	1-8
D	31	0	34	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B9779H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT E C D	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
	272	194.0	0.0	0.0	0.0	78.0	0.0
	92	74.0	0.0	0.0	0.0	17.0	0.0
	24	0.0	0.0	0.0	0.0	24.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB. FR-TO	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO					
E-B	-347.0	0.0	0.0	0.05 (4)	7.81			
A-B	0.30	-91.8	-91.8	0.14 (5)	10.00			
B-C	-21.0	-91.8	-91.8	0.23 (1)	6.25			
E-D	0.0	-18.5	-18.5	0.08 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 8 X 12 = 73 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
DL	= 8.0	PSF	
BOT CH.	LL	= 0.0	PSF
DL	= 7.4	PSF	
TOTAL LOAD	= 39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.01")

CSI: TC=0.23/1.00 (B-C:1), BC=0.08/1.00 (D-E:4), WB=0.00/1.00 (r/a:3), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	768	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.15 (E) (INPUT = 0.90)
JSI METAL = 0.10 (B) (INPUT = 1.00)

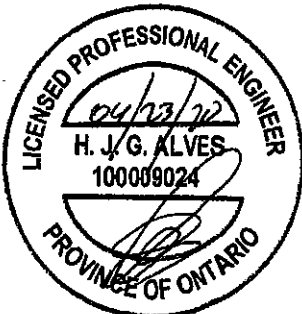

Structural component only
DWG# T-2006845

LUL/LUS/LJS/HUS/HHUS/HGUS

SIMPSON

Strong-Tie

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of a) easier installation, b) higher capacities, c) lower installed cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.

Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:

- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on p. 126.




Double-Shear Nailing Top View




Double-Shear Nailing Side View; Do not bend tab




Dome Double-Shear Nailing Side View (available on some models)
U.S. Patent 5,603,580

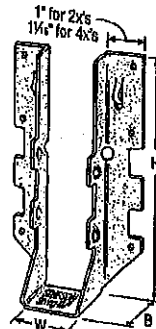


✓ LUS28




LU26L

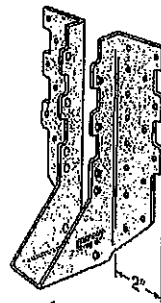


✓ HUS210
(HUS26, HUS28, and HHUS similar)



✓ HGUS28-2




✓ HHUS210-2



LJS26DS

Typical HUS26 Installation with Reduced Heel Height (Truss Designer to provide fastener quantity for connecting multiple members together)

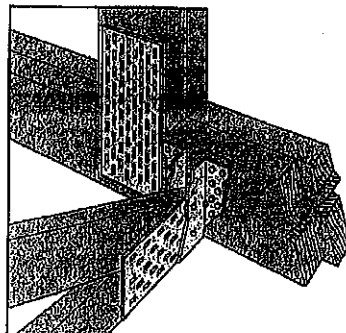

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options information on pp. 125–127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
$W < 2"$	Bevel or square cut	0.62 of table value	0.46 of table value
$2" < W < 6"$	Bevel cut	0.67 of table value	0.41 of table value
$2" < W < 6"$	Square cut	0.46 of table value	0.41 of table value
$W > 6"$	Bevel cut	0.75 of table value	0.41 of table value

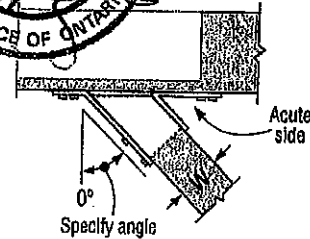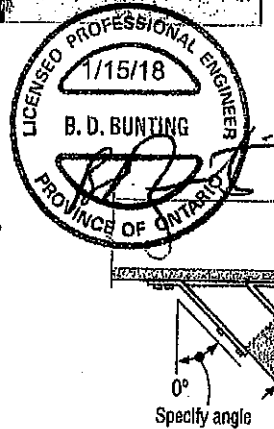

Top View HHUS Hanger Skewed Right
(joist must be bevel cut)
All joist nails installed on the outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance							
		W	H	B	d ₀ ³	Header	Joist	D-Fir-L		S-P-F					
								Uplift	Normal	Uplift	Normal				
								(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)				
								lb.	lb.	lb.	lb.				
kN												kN	kN	kN	kN
Single 2x Sizes															
LUS24	18	1 1/8	3 1/4	1 1/4	2 1/4	(4) 10d	(2) 10d	710	1625	645	1155				
								3.16	7.23	2.87	5.14				
LU24L	22	1 1/8	3	1 1/4	2 1/8	(4) 10d	(2) 10d x 1 1/2"	360	1020	320	725				
								1.60	4.54	1.42	3.22				
LU26L	22	1 1/8	5	1 1/4	4 1/4	(6) 10d	(4) 10d x 1 1/2"	720	1805	645	1140				
								3.20	7.14	2.87	5.07				
SS LUS26	18	1 1/8	4 1/4	1 1/4	3 3/4	(4) 10d	(4) 10d	1420	2170	1290	1630				
								6.32	9.65	5.74	7.25				
HUS28	16	1 1/8	5 1/4	3	3 3/8	(14) 16d	(6) 16d	2705	4840	2065	3875				
								11.80	21.97	9.20	17.24				
LJS26DS	18	1 1/8	5	3 1/4	4 1/4	(16) 16d	(6) 16d	2055	4265	1480	4115				
								9.14	18.97	6.49	18.31				
HGUS26	12	1 1/8	5 1/4	5	4 1/4	(20) 18d	(8) 16d	2685	6625	2685	5700				
								11.98	29.51	11.98	25.35				
LU28L	20	1 1/8	6 1/4	1 1/4	5 1/4	(8) 10d	(6) 10d x 1 1/2"	1140	2185	1020	1550				
								5.07	9.72	4.54	6.89				
SS LUS28	18	1 1/8	6 1/4	1 1/4	3 3/4	(8) 10d	(4) 10d	1420	2520	1290	1790				
								6.32	11.21	5.74	7.96				
HUS28	16	1 1/8	7 1/4	3	6 1/8	(22) 18d	(8) 18d	3605	5365	2675	4345				
								16.04	23.88	11.90	19.33				
HGUS28	12	1 1/8	7 1/4	5	6 1/4	(36) 18d	(12) 16d	3310	7675	3310	6900				
								14.74	34.19	14.74	30.73				
LU210L	20	1 1/8	8	1 1/4	7 1/4	(10) 10d	(6) 10d x 1 1/2"	1140	2495	1020	1770				
								5.07	11.10	4.54	7.87				
SS LUS210	18	1 1/8	7 1/4	1 1/4	3 3/4	(8) 10d	(4) 10d	1420	2785	1290	2210				
								6.32	12.39	5.74	9.83				

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_0 is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27–28 for other nail sizes and information.


Face-Mount Hangers

SIMPSON
Strong-Tie

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _a ³	Header	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)
								lb.	lb.	lb.	lb.
								kN	kN	kN	kN
Double 2x Sizes											
■ LUS24-2	18	3 3/8	3 3/8	2	1 1/8	(4) 16d	(2) 16d	835	2020	590	1435
SS LUS26-2	18	3 3/8	4 1/8	2	4	(4) 16d	(4) 16d	3.71	8.99	2.62	6.38
■ HHUS26-2	14	3 3/8	5 3/8	3	3 3/8	(14) 16d	(8) 16d	1720	2595	1545	1920
■ HGUS26-2	12	3 3/8	5 3/8	4	4 1/8	(20) 16d	(8) 16d	7.65	11.54	6.87	8.54
SS LUS28-2	18	3 3/8	7	2	4	(8) 16d	(4) 16d	2850	7335	2085	5205
■ HHUS28-2	14	3 3/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	12.68	32.63	9.20	23.15
■ HGUS28-2	12	3 3/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	4385	8950	3110	6355
SS LUS210-2	18	3 3/8	9	2	6	(8) 16d	(8) 16d	19.51	39.81	13.83	28.27
■ HHUS210-2	14	3 3/8	9 3/8	3	8	(30) 16d	(10) 16d	1720	3325	1545	2575
■ HGUS210-2	12	3 3/8	9 3/8	4	8 1/8	(48) 16d	(16) 16d	7.65	14.79	6.87	11.45
								3765	8940	2675	6345
								16.75	39.77	11.90	28.22
								6070	12980	4310	9215
								27.00	57.74	19.17	40.99
								2580	4500	2320	3195
								11.48	20.02	10.32	14.21
								6840	9680	4235	7000
								20.77	42.97	18.84	31.14
								6840	14015	4855	10270
								30.43	62.34	21.60	45.69
Triple 2x Sizes											
■ HGUS26-3	12	4 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
■ HGUS28-3	12	4 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	19.51	39.81	13.83	28.27
■ HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d	6070	12980	4310	9215
■ HGUS210-3	12	4 1/8	9 1/8	4	8 1/8	(48) 16d	(16) 16d	27.00	57.74	19.17	40.99
								4670	9670	4235	6865
								20.77	43.02	18.84	30.54
								6840	14645	4855	10400
								30.43	65.14	21.60	46.26
Quadruple 2x Sizes											
■ HGUS26-4	12	6 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
■ HGUS28-4	12	6 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	19.51	39.81	13.83	28.27
■ HHUS210-4	14	6 1/8	8 1/8	3	7 1/8	(30) 16d	(10) 16d	6070	12980	4310	9215
■ HGUS210-4	12	6 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	27.00	57.74	19.17	40.99
								4670	10155	4235	7210
								20.77	45.17	18.84	32.07
								6840	14645	4855	10400
								30.43	65.14	21.60	46.26
								7840	14995	5425	10645
								33.08	66.70	24.13	47.35
								10130	16400	7195	11645
								45.06	72.95	32.00	51.80
4x Sizes											
■ LUS46	18	3 3/8	4 3/8	2	3 3/8	(4) 16d	(4) 16d	1720	2595	1545	1920
■ HHUS46	14	3 3/8	5 1/8	3	3 3/8	(14) 16d	(6) 16d	7.65	11.54	6.87	8.54
■ HGUS46	12	3 3/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	2540	7335	2085	5205
■ LUS48	18	3 3/8	6 3/8	2	3 3/8	(8) 16d	(4) 16d	11.30	32.63	9.20	23.15
■ HHUS48	14	3 3/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	4385	8950	3110	6355
■ HGUS48	12	3 3/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	19.51	39.81	13.83	28.27
■ LUS410	18	3 3/8	8 3/8	2	5 3/8	(8) 16d	(6) 16d	1720	3325	1545	2575
■ HHUS410	14	3 3/8	9 1/8	3	8 1/8	(30) 16d	(10) 16d	7.65	14.79	6.87	11.45
■ HGUS410	12	3 3/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	3765	8940	2675	6345
■ LUS412	18	3 3/8	10 3/8	2	6 3/8	(8) 16d	(6) 16d	16.75	39.77	11.90	28.22
■ HHUS412	14	3 3/8	11 1/8	3	9 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
■ HGUS412	12	3 3/8	11 1/8	4	10 3/8	(56) 16d	(20) 16d	27.00	57.74	19.17	40.99
■ LUS414	18	3 3/8	12 3/8	2	7 3/8	(8) 16d	(6) 16d	2580	4500	2320	3195
■ HHUS414	14	3 3/8	13 1/8	3	10 3/8	(36) 16d	(12) 16d	11.48	20.02	10.32	14.21
■ HGUS414	12	3 3/8	13 1/8	4	11 3/8	(66) 16d	(22) 16d	6840	14015	4855	10270
								30.43	62.34	21.60	45.69
								7640	14995	5425	10645
								33.08	66.70	24.13	47.35
								10130	16400	7195	11645
								45.06	72.95	32.00	51.80



Plated Truss Connectors

See footnotes
on p. 258.

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1 1/4". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

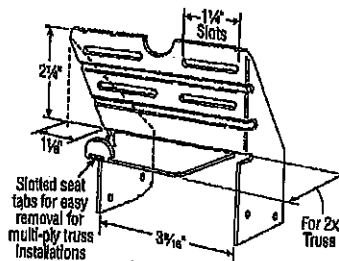


TC24
U.S. Patent 4,932,173

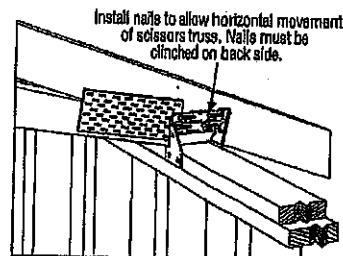


Typical TC24 Installation

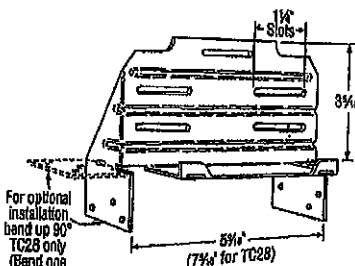

TC26
(TC28 Similar)

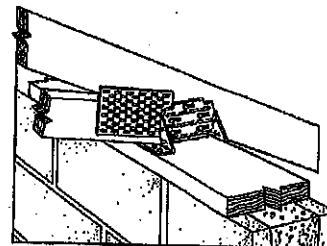

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer (8", 10", 12" Wall Installation Similar)

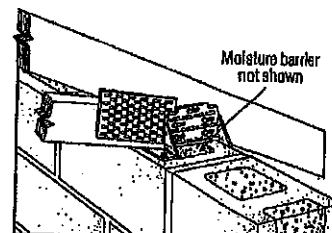

Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D-Fir-L	S-P-F
			Uplift (K ₀ =1.15)	Uplift (K ₀ =1.15)
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(8) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D-Fir-L	S-P-F
			Uplift (K ₀ =1.15)	Uplift (K ₀ =1.15)
TC26	(5) 10d	(8) 10d x 1 1/4"	810	660
	(5) 10d	(8) 10d	930	660

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.

2. Grout strength is 15 MPa minimum.

3. Optional TC26 installation with 10d nails requires minimum 3" top plate thickness.

4. TC26 fastened to grouted concrete block with (8) - 3/8" x 2 1/4" Titen screws has a factored uplift resistance of 275 lb.



(800) 999-5099
strongtie.com

H/TSP

SIMPSON
Strong-Tie

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_F = 1.15$)					
					D.Fir-L			S-P-F		
		To Rafters/Truss	To Plates	To Studs	Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(6) 8d x 1 1/2"	(4) 8d	—	740	685	300	680	485	215
					3.29	3.05	1.33	3.02	2.16	0.96
SS H2A	18	(5) 8d x 1 1/2"	(2) 8d x 1 1/2"	(5) 8d x 1 1/2"	830	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	180	160	755	160	160
					3.68	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	160	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	285	615	125	190
					3.29	0.80	1.18	2.74	0.56	0.85
H6	16	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	18	(4) 8d	(2) 8d	(8) 8d	1390	870	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS H8 ²	18	(5) 10d x 1 1/2"	(5) 10d x 1 1/2"	—	1120	—	—	1025	—	—
					4.98	—	—	4.56	—	—
SS H10A ²	18	(9) 10d x 1 1/2"	(9) 10d x 1 1/2"	—	1735	795	410	1505	585	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1 1/2"	(9) 10d x 1 1/2"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.54	1.36
H10A-2	18	(8) 10d x 1 1/2"	(9) 10d x 1 1/2"	—	1835	1275	430	1645	880	305
					8.16	5.67	1.91	7.32	3.91	1.36
H10S ^{2A}	18	(8) 8d x 1 1/2"	(8) 8d x 1 1/2"	(8) 8d	1465	795	315	1040	585	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2 1/2"	(6) 16d x 2 1/2"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	[1] (12) 8d x 1 1/2"	(13) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
		[2] (12) 8d x 1 1/2"	(15) 8d	—	2390	855	320	1805	610	230
TSP	16	(9) 10d x 1 1/2"	(6) 10d x 1 1/2"	—	10.63	3.80	1.42	8.03	2.71	1.02
					1295	440	—	920	310	—
		(9) 10d x 1 1/2"	(6) 10d	—	5.76	1.98	—	4.09	1.38	—
					1560	440	—	1105	310	—
					6.94	1.98	—	4.92	1.38	—

- Factored resistances have been increased 15% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2 1/2" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 595 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 8/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1 1/2" nails into the top plates and (3) 8d x 1 1/2" nails into the lowest three flange holes into the truss bottom chord is 495 lb. (2.20 kN).
- Nails: 16d x 2 1/2" = 0.162" dia. x 2 1/2" long, 10d = 0.148" dia. x 3" long, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long, 8d = 0.131" dia. x 2 1/2" long, 8d x 1 1/2" = 0.131" dia. x 1 1/2" long. See pp. 27-28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4.
10. This design is not valid after March 31, 2021.

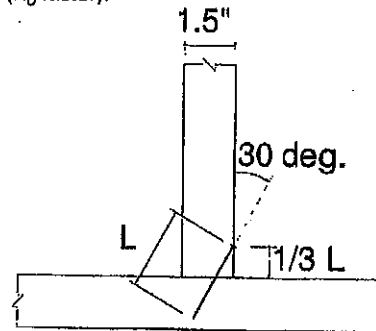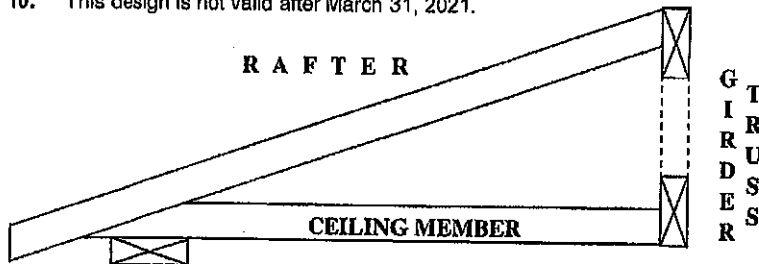

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (In)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019

PEO
Certificate No. 10889485



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to wind or earthquake load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

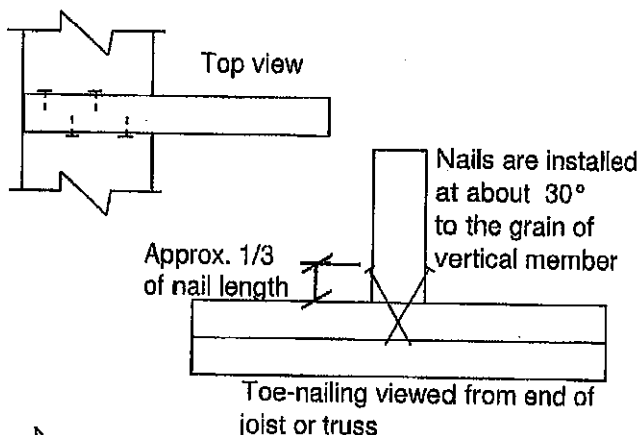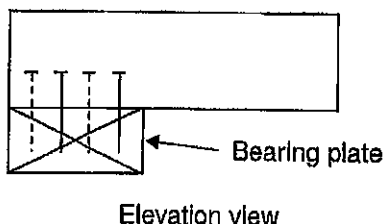

Toe-nailing on 2x4 Bearing Plate

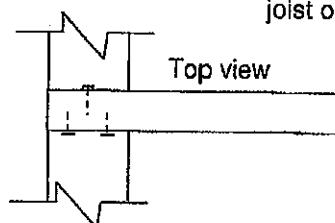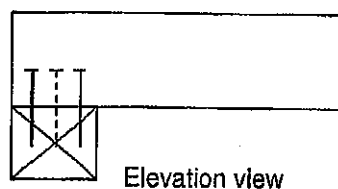


MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7




December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint, unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/4" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

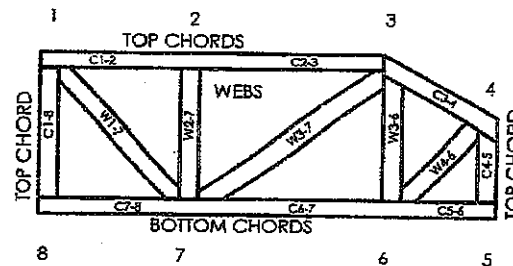

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MIT-7473C rev. 10-08



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See 8CSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

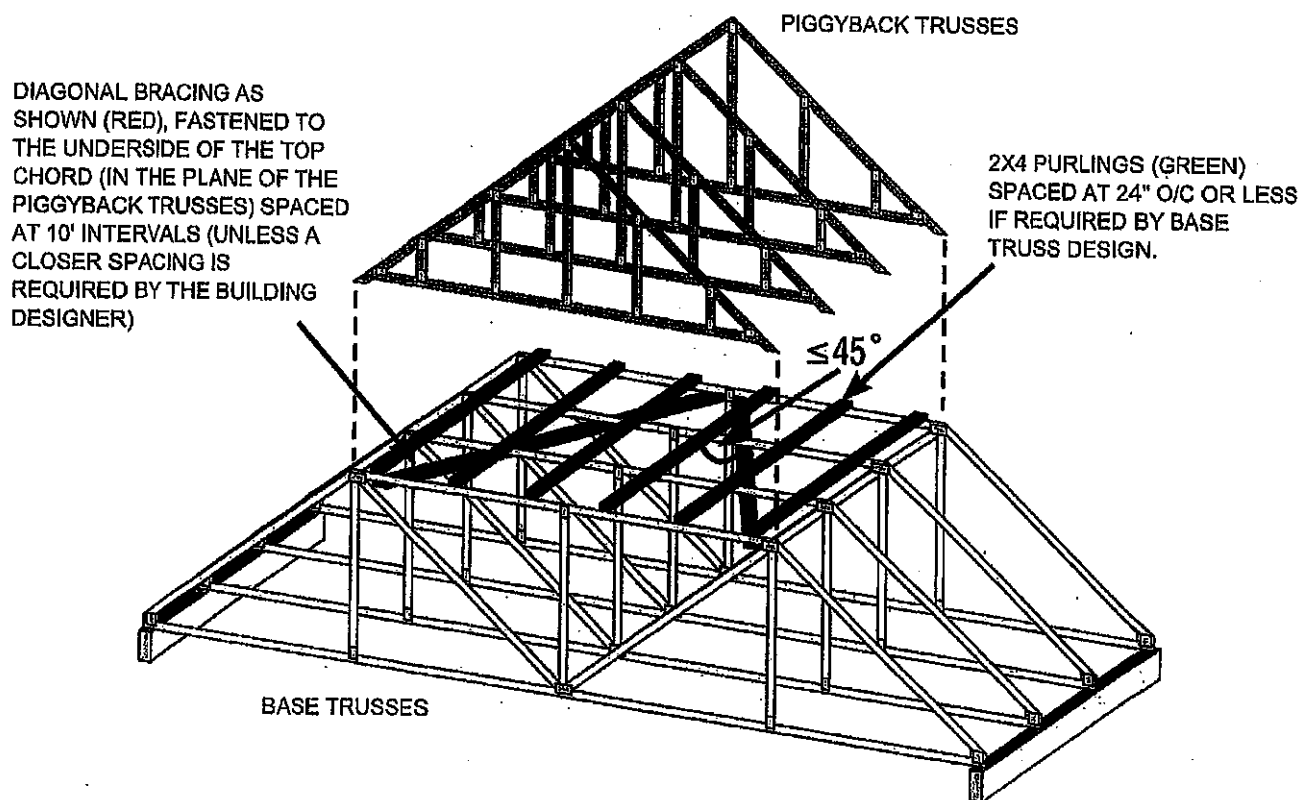


NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1800213

Feb 09, 2018