


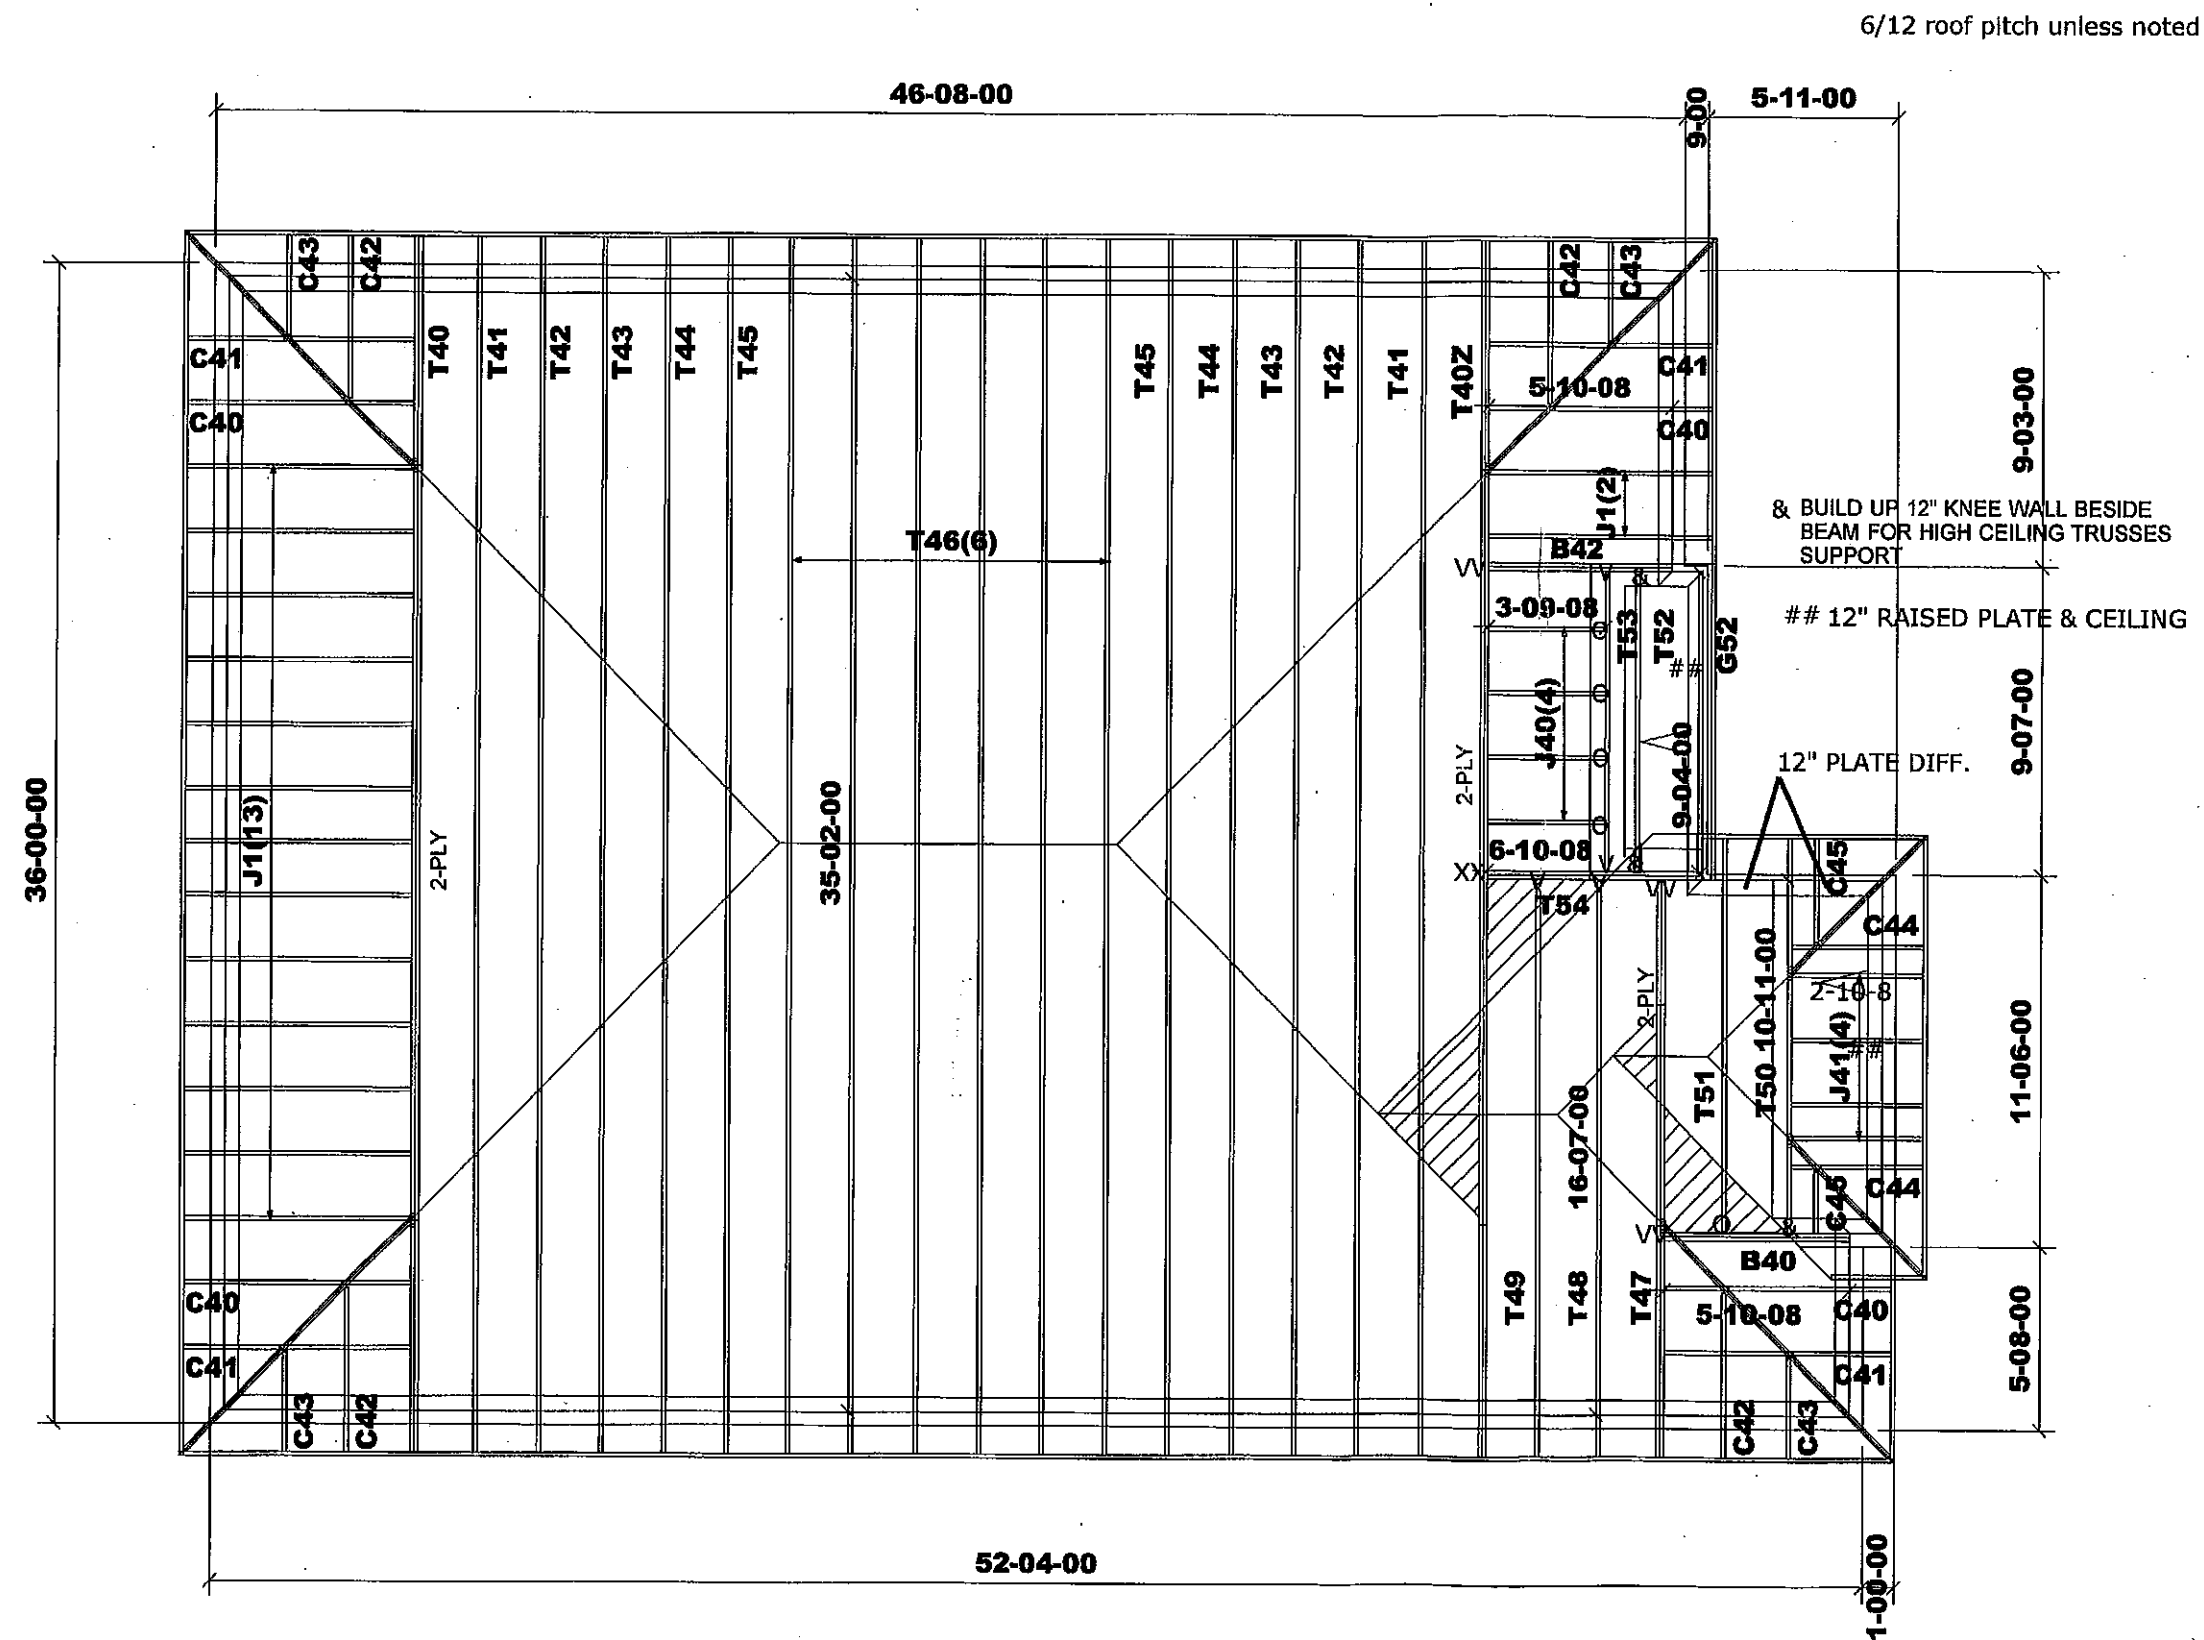

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment).
Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:

TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

CITY OF HAMILTON
Building Division

HARDWARE:

LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)
LUS26-2-(VV)

Permit No. 21-105958
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

BEAMS:

B40= B41 = B42= 2 - 2x10 SPF #2

These drawings and/or specifications have been reviewed by
FOR CHIEF BUILDING OFFICIAL
DATE

 DENOTES:
CONVENTIONAL
FRAMING

M13125



Job Track: 51225
Plan Log: 202401
Layout ID: 408152

Builder / Location:
GREEN PARK HOMES / WATERDOWN

Project: RUSSELL GARDENS PH.3

Date: 2020-04-27 Sales: Mario DiCano Designer: JG

Model / Elevation:
MOUNTAINASH 4/3- std. or opt.

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

Model ver 8.3.1.215

LOT 235



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 4
 Lot #: 235
 Elevation: 3- std. or opt.

Job Track: 51225
 PlanLog: 202401
 Layout ID: 408152
 Ref #
 Page: 1 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T40 Hip Girder	6 / 12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	340.74 212.00		
	1 2-ply	T40Z Hip Girder	6 / 12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	340.74 212.00		
	2	T41 Hip	6 / 12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.99 174.00		
	2	T42 Hip	6 / 12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.12 174.67		
	2	T43 Hip	6 / 12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	289.07 179.67		
	2	T44 Hip	6 / 12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	290.73 183.33		
	2	T45 Hip	6 / 12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	301.67 191.33		
	6	T46 Common	6 / 12	35-02-00	9-11-08	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	910.08 568.00		
	1 2-ply	T47 Hip Girder	6 / 12	16-07-00	4-01-04	2 x 4 2 x 6	1-03-08	1-02-00 2-02-00	156.02 100.67		
	1	T48 Hip	6 / 12	16-07-00	5-01-04	2 x 4	1-03-08	1-02-00 2-02-00	68.15 43.33		
	1	T49 Common	6 / 12	16-07-00	5-09-12	2 x 4	1-03-08	1-02-00 2-02-00	67.14 42.33		
	1	T50 Hip Girder	6 / 12	10-11-00	2-07-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	42.73 28.33		
	1	T51 Hip	6 / 12	10-11-00	4-07-04	2 x 4	1-03-08 1-03-08	2-02-00 2-02-00	51.54 34.50		
	1	T52 Flat	0 / 12	9-04-00	2-10-00	2 x 4		2-10-00 2-10-00	36.11 23.83		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 4
 Lot #: 235
 Elevation: 3- std. or opt.

Job Track: 51225
 PlanLog: 202401
 Layout ID: 408152
 Ref #
 Page: 2 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	G52 GABLE	0/12	9-04-00	2-10-00	2 x 4		2-10-00 2-10-00	33.75 23.33		
	1	T53 Flat Girder	0/12	9-04-00	3-10-00	2 x 6		3-10-00 3-10-00	50.9 31.50		
	1 2-ply	T54 Jack-Closed Girder	6/12	6-10-08	4-01-04	2 x 4 2 x 6		8-00 4-01-04	69.61 37.33		
	15	J1 Jack-Open	6/12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	251.92 160.00		
	4	J40 Jack-Open	6/12	3-09-08	4-01-04	2 x 4		2-02-08 4-01-04	52.34 35.33		
	4	J41 Jack-Open	6/12	2-10-08	2-07-04	2 x 4	1-03-08	1-02-00 2-07-04	38.2 24.00		
	4	C40 Jack-Open	6/12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	56.53 34.67		
	4	C41 Jack-Open	6/12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	46.33 29.33		
	4	C42 Jack-Open	6/12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	38.28 24.00		
	4	C43 Jack-Open	6/12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	28.08 18.67		
	2	C44 Jack-Open	6/12	1-10-15	2-01-08	2 x 4	1-03-08 11-09	1-02-00 2-01-08	16.64 10.67		
	2	C45 Jack-Open	6/12	1-10-15	2-01-08	2 x 4	1-03-08 1-01	1-02-00 2-01-08	14.65 9.33		

TOTAL # TRUSS= 74

TOTAL BFT OF ALL TRUSSES= 2596.15

BFT.

TOTAL WEIGHT OF ALL TRSSES 4137.05 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	HGUS26-2	
4	Hardware	LJS26DS	

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 4
 Lot #: 235
 Elevation: 3- std. or opt.

Job Track: 51225
 PlanLog: 202401
 Layout ID: 408152
 Ref #
 Page: 3 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano


HARDWARE

QTY	TYPE	MODEL	LENGTH
5	Hardware	LUS24	
3	Hardware	LUS26-2	

TOTAL NUMBER OF
ITEMS= 13

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408150	T1	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Sat Apr 25 11:02:47 2020 Page 1
 ID:7vF7aG0E03cRUj6X1JSrkziWYK-VShX5DRAXNen15LAM_IsZu8zCRhplkACNpVGMzNCnc
 Scale = 1/32"

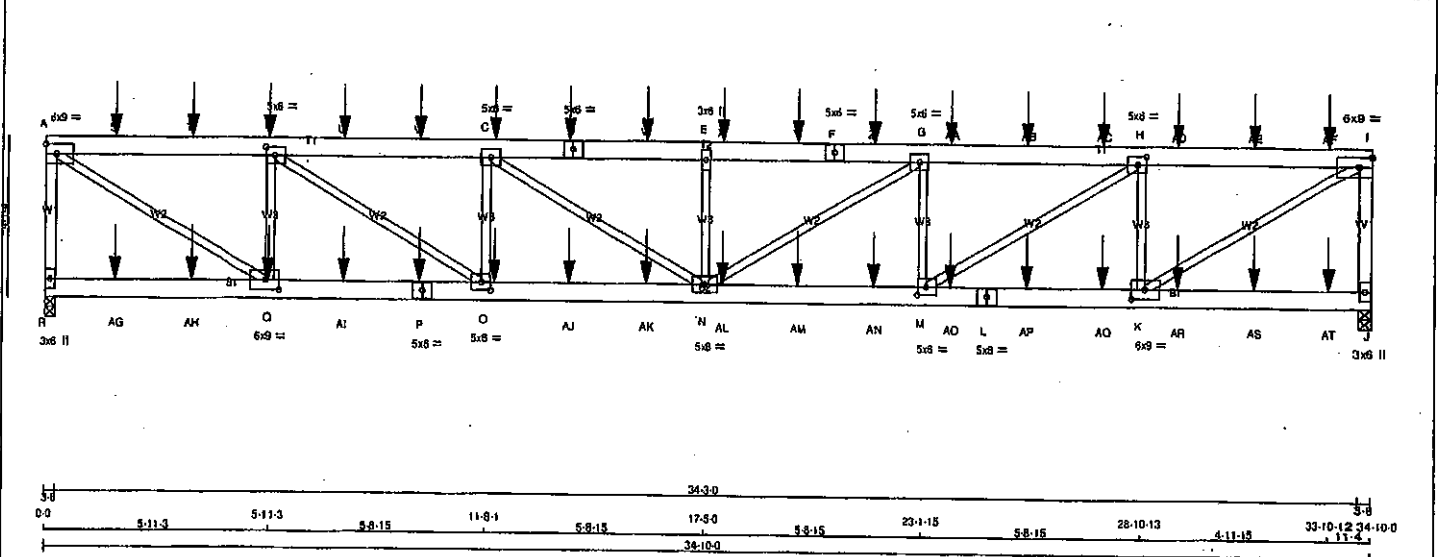

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
R - A	2x4	DRY	No.2
A - D	2x8	DRY	No.2
D - F	2x8	DRY	No.2
F - I	2x8	DRY	No.2
J - I	2x4	DRY	No.2
R - P	2x8	DRY	No.2
P - L	2x8	DRY	No.2
L - J	2x8	DRY	No.2

ALL WEBS 2x3 DRY No.2
 DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
R-A	12	TOP
A-D	12	TOP
D-F	12	SIDE(183.1)
F-I	12	SIDE(0.0)
I-J	12	SIDE(0.0)
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
R-P	12	SIDE(183.1)
P-L	12	SIDE(183.1)
L-J	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
		GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ		DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
R	3052	0		3052	0	0	3-8	3-8	
J	3118	0		3118	0	0	3-8	3-8	

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	2181	1401.0	0.0	0.0	0.0	761.0	0.0
J	2209	1430.0	0.0	0.0	0.0	778.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
R-A	-2974.0	0.0	0.0 0.34 (1)	6.68	K-I	0.7 5083	0.63 (1)
A-S	-4326.0	-91.8	-91.8 0.20 (1)	5.32	A-Q	0.7 5078	0.63 (1)
S-T	-4326.0	-91.8	-91.8 0.20 (1)	5.32	K-H	-2485.0	0.30 (1)
T-B	-4326.0	-91.8	-91.8 0.20 (1)	5.32	Q-B	-2483.0	0.29 (1)
B-U	-6896.0	-91.8	-91.8 0.25 (1)	4.43	M-H	0.7 2804	0.35 (1)
U-V	-6896.0	-91.8	-91.8 0.25 (1)	4.43	B-O	0.7 2808	0.35 (1)
V-C	-6896.0	-91.8	-91.8 0.25 (1)	4.43	M-G	-1325.0	0.16 (1)
C-D	-7505.0	-91.8	-91.8 0.23 (1)	4.25	O-C	-1326.0	0.16 (1)
D-W	-7505.0	-91.8	-91.8 0.23 (1)	4.25	N-G	0.7 958	0.12 (1)
W-E	-7505.0	-91.8	-91.8 0.23 (1)	4.25	C-N	0.7 958	0.12 (1)
E-X	-7505.0	-91.8	-91.8 0.23 (1)	4.25	N-E	-851.0	0.10 (1)
X-Y	-7505.0	-91.8	-91.8 0.23 (1)	4.25			
Y-F	-7505.0	-91.8	-91.8 0.23 (1)	4.25			
F-Z	-7505.0	-91.8	-91.8 0.23 (1)	4.25			
Z-G	-7505.0	-91.8	-91.8 0.23 (1)	4.25			
G-AA	-6898.0	-91.8	-91.8 0.26 (1)	4.42			
AA-AB	-6898.0	-91.8	-91.8 0.26 (1)	4.42			
AB-AC	-6898.0	-91.8	-91.8 0.26 (1)	4.42			
AC-H	-6898.0	-91.8	-91.8 0.26 (1)	4.42			
H-AD	-4330.0	-91.8	-91.8 0.21 (1)	5.30			
AD-AE	-4330.0	-91.8	-91.8 0.21 (1)	5.30			
AE-AF	-4330.0	-91.8	-91.8 0.21 (1)	5.30			
AF-I	-4330.0	-91.8	-91.8 0.21 (1)	5.30			
I-J	-3028.0	0.0	0.0 0.35 (1)	6.64			

R-AG	0.0	-18.5	-18.5 0.06 (4)	10.00
AG-AH	0.0	-18.5	-18.5 0.06 (4)	10.00
AH-Q	0.0	-18.5	-18.5 0.06 (4)	10.00
Q-AI	0.4326	-18.5	-18.5 0.33 (1)	10.00
AI-P	0.4326	-18.5	-18.5 0.33 (1)	10.00
P-O	0.4326	-18.5	-18.5 0.33 (1)	10.00
O-AJ	0.6896	-18.5	-18.5 0.49 (1)	10.00
AJ-AK	0.6896	-18.5	-18.5 0.49 (1)	10.00
AK-N	0.6896	-18.5	-18.5 0.49 (1)	10.00
N-AL	0.6896	-18.5	-18.5 0.49 (1)	10.00
AL-AM	0.6896	-18.5	-18.5 0.49 (1)	10.00
AM-AN	0.6896	-18.5	-18.5 0.49 (1)	10.00
AN-M	0.6896	-18.5	-18.5 0.49 (1)	10.00
M-AO	0.4330	-18.5	-18.5 0.33 (1)	10.00
AO-L	0.4330	-18.5	-18.5 0.33 (1)	10.00
L-AP	0.4330	-18.5	-18.5 0.33 (1)	10.00
AP-AQ	0.4330	-18.5	-18.5 0.33 (1)	10.00
AQ-K	0.4330	-18.5	-18.5 0.33 (1)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	25.6	PSF
DL		6.0	PSF
BOT CH.	LL	0.0	PSF
DL		7.4	PSF
TOTAL LOAD		39.0	PSF

SPACING = 24.0 IN/GC

LOADING IN PLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-04, CSA 086-14
 - TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.16")
 CALCULATED VERT. DEFL.(LL) = $L/999$ (0.20")
 ALLOWABLE DEFL.(TL) = $L/360$ (1.16")
 CALCULATED VERT. DEFL.(TL) = $L/999$ (0.38")

CSI: TC=0.35/1.00 (I-J); BC=0.48/1.00 (M-N);
 WB=0.63/1.00 (K-I); SS=0.17/1.00 (H-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 818 354 1687 788 1987 1655

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.66 (K) (INPUT = 0.90)
 JSI METAL= 0.42 (P) (INPUT = 1.00)

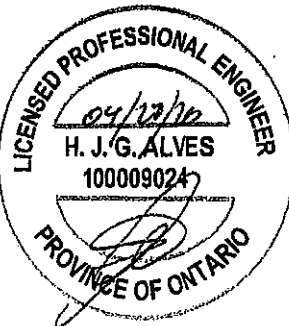

Structural component only
 DWG# T-2007063 1/2

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-I	MT20	6.0	9.0		Edge
B	TMVW-I	MT20	5.0	6.0	2.50	2.75
C	TMVW-I	MT20	5.0	6.0		
D	TS-I	MT20	5.0	6.0		
E	TMVW-w	MT20	3.0	6.0		
F	TS-I	MT20	5.0	6.0		
G	TMVW-I	MT20	5.0	6.0		
H	TMVW-I	MT20	5.0	6.0	2.50	2.75
I	TMVW-I	MT20	6.0	9.0		Edge
J	BMV1+p	MT20	3.0	6.0		
K	BMVW-I	MT20	6.0	9.0	3.00	4.25
L	BS-I	MT20	5.0	6.0		
M	BMVW-I	MT20	5.0	6.0	2.50	2.75
N	BMVW-I	MT20	5.0	6.0		
O	BMVW-I	MT20	5.0	6.0	2.50	2.75
P	BS-I	MT20	5.0	6.0		
Q	BMVW-I	MT20	6.0	9.0	3.00	4.25
R	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO				
K-AR	0/0	-18.5	-18.5 0.08 (4)	10.00		
AR-AS	0/0	-18.5	-18.5 0.08 (4)	10.00		
AS-AT	0/0	-18.5	-18.5 0.08 (4)	10.00		
AT-J	0/0	-18.5	-18.5 0.08 (4)	10.00		

WEBS

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
B	5-10-12	-110	-110		FRONT	VERT	TOTAL		C1
C	11-10-12	-110	-110		FRONT	VERT	TOTAL		C1
D	13-10-12	-110	-110		FRONT	VERT	TOTAL		C1
O	11-10-12	-26	-26		FRONT	VERT	TOTAL		C1
P	9-10-12	-28	-28		FRONT	VERT	TOTAL		C1
Q	5-10-12	-28	-28		FRONT	VERT	TOTAL		C1
S	1-10-12	-110	-110		FRONT	VERT	TOTAL		C1
T	3-10-12	-110	-110		FRONT	VERT	TOTAL		C1
U	7-10-12	-110	-110		FRONT	VERT	TOTAL		C1
V	9-10-12	-110	-110		FRONT	VERT	TOTAL		C1
W	15-10-12	-110	-110		FRONT	VERT	TOTAL		C1
X	17-10-12	-110	-110		FRONT	VERT	TOTAL		C1
Y	19-10-12	-110	-110		FRONT	VERT	TOTAL		C1
Z	21-10-12	-110	-110		FRONT	VERT	TOTAL		C1
AA	23-10-12	-110	-110		FRONT	VERT	TOTAL		C1
AB	25-10-12	-110	-110		FRONT	VERT	TOTAL		C1
AC	27-10-12	-110	-110		FRONT	VERT	TOTAL		C1
AD	29-10-12	-110	-110		FRONT	VERT	TOTAL		C1
AE	31-10-12	-110	-110		FRONT	VERT	TOTAL		C1
AF	33-10-12	-113	-113		FRONT	VERT	TOTAL		C1
AG	1-10-12	-26	-26		FRONT	VERT	TOTAL		C1
AH	3-10-12	-28	-28		FRONT	VERT	TOTAL		C1
AI	7-10-12	-28	-28		FRONT	VERT	TOTAL		C1
AJ	13-10-12	-28	-28		FRONT	VERT	TOTAL		C1
AK	15-10-12	-28	-28		FRONT	VERT	TOTAL		C1
AL	17-10-12	-28	-28		FRONT	VERT	TOTAL		C1
AM	19-10-12	-28	-28		FRONT	VERT	TOTAL		C1
AN	21-10-12	-28	-28		FRONT	VERT	TOTAL		C1
AO	23-10-12	-28	-28		FRONT	VERT	TOTAL		C1
AP	25-10-12	-28	-28		FRONT	VERT	TOTAL		C1
AD	27-10-12	-28	-28		FRONT	VERT	TOTAL		C1
AR	29-10-12	-28	-28		FRONT	VERT	TOTAL		C1
AS	31-10-12	-28	-28		FRONT	VERT	TOTAL		C1
AT	33-10-12	-27	-27		FRONT	VERT	TOTAL		C1


CONNECTION REQUIREMENTS
 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



JOB NAME 408150	TRUSS NAME T1Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:02:49 2020 Page 1
ID:7vF?ag0E03cRUj6X1jSrkziWYK-zfWzSolhMelfWnWhG566h7Ury008GacTEqvOzNCnb

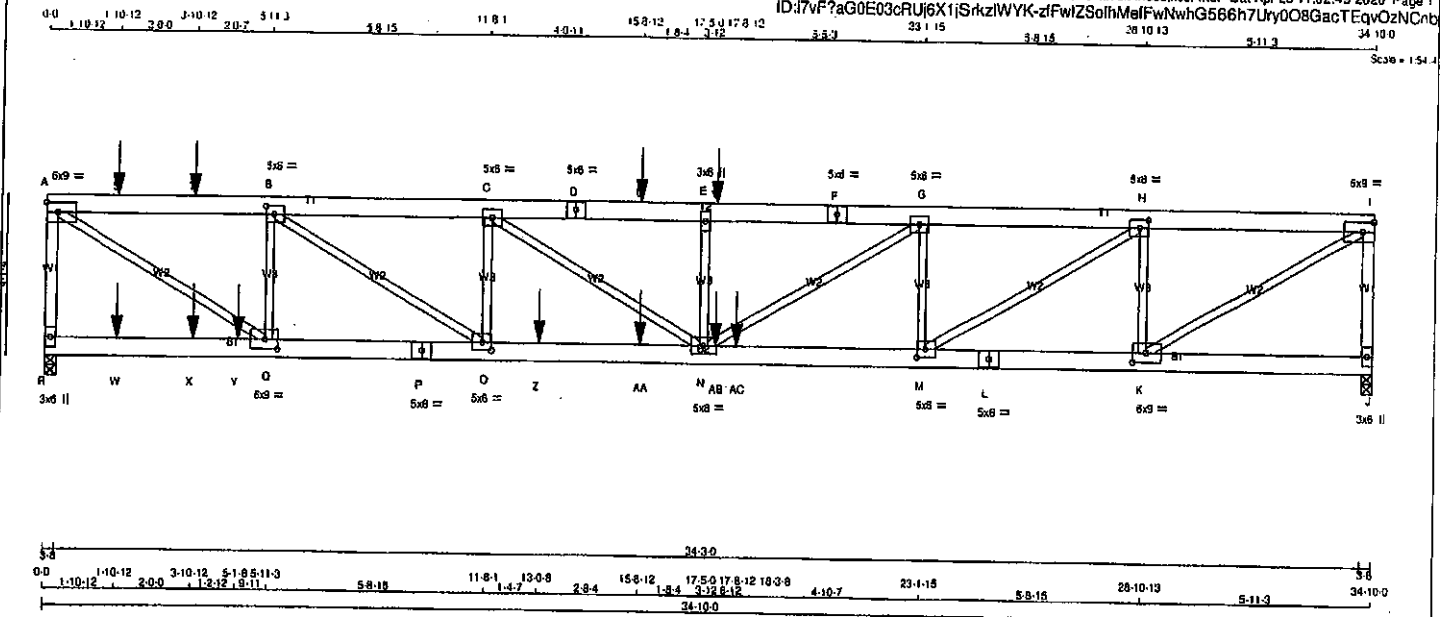

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
R - A	2x4	DRY	No.2	SPF		
A - D	2x6	DRY	No.2	SPF		
D - F	2x6	DRY	No.2	SPF		
F - I	2x6	DRY	No.2	SPF		
J - L	2x4	DRY	No.2	SPF		
R - P	2x6	DRY	No.2	SPF		
P - L	2x6	DRY	No.2	SPF		
L - J	2x6	DRY	No.2	SPF		

ALL WEBS 2x3 DRY, SEASONED LUMBER. No.2 SPF

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
R - A 1	12	TOP
I - J 1	12	TOP
A - D 2	12	SIDE(0.0)
D - F 2	12	SIDE(183.1)
F - I 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
R - P 2	12	SIDE(0.0)
P - L 2	12	SIDE(183.1)
L - J 2	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED		MAXIMUM FACTORED		INPUT	REQD
	GROSS REACTION	DOWN	GROSS REACTION	UP		
JT	4002	0	4002	0	3-8	3-8
R	3132	0	3132	0	3-8	3-8

UNFACTORED REACTIONS

1ST LOASE	MAX./MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
R	2824 1888 / 0 0 / 0 0 / 0 0 938 / 0 0 / 0
J	2212 1470 / 0 0 / 0 0 / 0 0 742 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.84 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LOC	MAX	MAX.	MEMB.	MAX. FACTORED
MEMB.	FORCE (LBS)	FORCE (PLF)	CSF (LC)	UNBRAC	LENGTH	FR-TO	FR-TO	FORCE (LBS)
FR-TO								
R-A	-3851 / 0	0.0	0.0	0.44 (1)	8.01	K-I	0 / 5428	0.87 (1)
A-S	-5722 / 0	-91.8	-91.8	0.25 (1)	4.72	A-Q	0 / 6717	0.83 (1)
S-T	-5722 / 0	-91.8	-91.8	0.25 (1)	4.72	K-H	-2763 / 0	0.33 (1)
T-B	-5722 / 0	-91.8	-91.8	0.25 (1)	4.72	Q-B	-2710 / 0	0.32 (1)
B-C	-8846 / 0	-91.8	-91.8	0.27 (1)	3.93	M-H	0 / 4038	0.50 (1)
C-D	-10219 / 0	-91.8	-91.8	0.34 (1)	3.64	B-O	0 / 3700	0.46 (1)
D-U	-10219 / 0	-91.8	-91.8	0.34 (1)	3.64	M-G	-1901 / 0	0.23 (1)
U-E	-10219 / 0	-91.8	-91.8	0.34 (1)	3.64	O-C	-1400 / 0	0.17 (1)
E-V	-10219 / 0	-91.8	-91.8	0.31 (1)	3.67	N-G	0 / 2591	0.32 (1)
V-F	-10219 / 0	-91.8	-91.8	0.31 (1)	3.67	C-N	0 / 1826	0.20 (1)
F-G	-10219 / 0	-91.8	-91.8	0.31 (1)	3.67	N-E	-710 / 0	0.08 (1)
G-H	-8031 / 0	-91.8	-91.8	0.23 (1)	4.14			
H-I	-4622 / 0	-91.8	-91.8	0.15 (1)	5.25			
J-I	-3071 / 0	0.0	0.0	0.35 (1)	6.60			

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LOC	MAX	MAX.	MEMB.	MAX. FACTORED
MEMB.	FORCE (LBS)	FORCE (PLF)	CSF (LC)	UNBRAC	LENGTH	FR-TO	FR-TO	FORCE (LBS)
FR-TO								
R-W	0 / 0	-18.5	-18.5	0.15 (1)	10.00			
W-X	0 / 0	-18.5	-18.5	0.15 (1)	10.00			
X-Y	0 / 0	-18.5	-18.5	0.15 (1)	10.00			
Y-Q	0 / 0	-18.5	-18.5	0.15 (1)	10.00			
Q-P	0 / 5722	-18.5	-18.5	0.44 (1)	10.00			
P-O	0 / 5722	-18.5	-18.5	0.44 (1)	10.00			
O-Z	0 / 8846	-18.5	-18.5	0.81 (1)	10.00			
Z-AA	0 / 8846	-18.5	-18.5	0.81 (1)	10.00			
AA-N	0 / 8846	-18.5	-18.5	0.81 (1)	10.00			
N-AB	0 / 8031	-18.5	-18.5	0.74 (1)	10.00			
AB-AC	0 / 8031	-18.5	-18.5	0.74 (1)	10.00			
AC-M	0 / 8031	-18.5	-18.5	0.74 (1)	10.00			
M-L	0 / 4622	-18.5	-18.5	0.33 (1)	10.00			
L-K	0 / 4622	-18.5	-18.5	0.33 (1)	10.00			
K-J	0 / 0	-18.5	-18.5	0.04 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC	LOC	MAX	MAX	FACE	DIR.	TYPE	HEEL	CONN.
T	1-10-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
S	3-10-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
U	15-8-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	17-8-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
W	1-10-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
X	3-10-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
Y	5-1-8	-727	-727	---	BACK	VERT	TOTAL	---	C1
Z	13-0-8	-727	-727	---	BACK	VERT	TOTAL	---	C1
AA	15-8-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
AB	17-8-12	-28	-28	---	BACK	VERT	TOTAL	---	C1

TOTAL WEIGHT = 2 X 176 = 353 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCO 2010, NBCO 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.28")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/828 (0.50")

CSI: TC=0.44/1.00 (A-R:1), BC=0.81/1.00 (N-O:1), WB=0.83/1.00 (A-Q:1), SS=0.41/1.00 (M-N:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLF) (PLF)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (M) (INPUT = 0.90)
JSI METAL= 0.50 (P) (INPUT = 1.00)

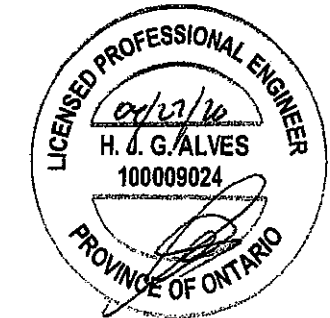

Structural component only
DWG# T-2007084 1/2

JOB NAME 408150	TRUSS NAME T1Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Sat Apr 25 11:02:49 2020 Page 2
ID: i7vF7aG0E03cRU8X1SRkzIWK-Sr0VvTQ3 UVGPVZTPnKaJDIEFIF7bWig7 NRrzNCna

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWW-1	MT20	6.0	9.0		Edge
B	TMWW-1	MT20	5.0	8.0	2.50	2.75
C	TMWW-1	MT20	5.0	6.0		
D	TS-1	MT20	5.0	6.0		
E	TMW-w	MT20	3.0	6.0		
F	TS-1	MT20	5.0	6.0		
G	TMWW-1	MT20	5.0	8.0		
H	TMWW-1	MT20	5.0	8.0	2.50	2.75
I	TMWW-1	MT20	6.0	9.0		Edge
J	BMV1+p	MT20	3.0	6.0		
K	BMWW-1	MT20	6.0	9.0	3.00	4.25
L	BS-1	MT20	5.0	6.0		
M	BMWW-1	MT20	5.0	8.0	2.50	2.75
N	BMWW-1	MT20	5.0	8.0		
O	BMWW-1	MT20	5.0	8.0	2.50	2.75
P	BS-1	MT20	5.0	6.0		
Q	BMWW-1	MT20	6.0	9.0	3.00	4.25
R	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
AC	18-3-8	-1293	-1293	--	BACK	VERT	TOTAL	--	C1

CONNECTION REQUIREMENTS


1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007064 72

JOB NAME 408150	TRUSS NAME T2	QUANTITY 2	PLY 1	JOB DESC GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:02:50 2020 Page 1
ID:7vF7aG0E03cRUJ6X1jSrkzWYK-w1MqjFT2qldMuZ416iZBXmNxeiPs5W3nJxzHzNCnZ

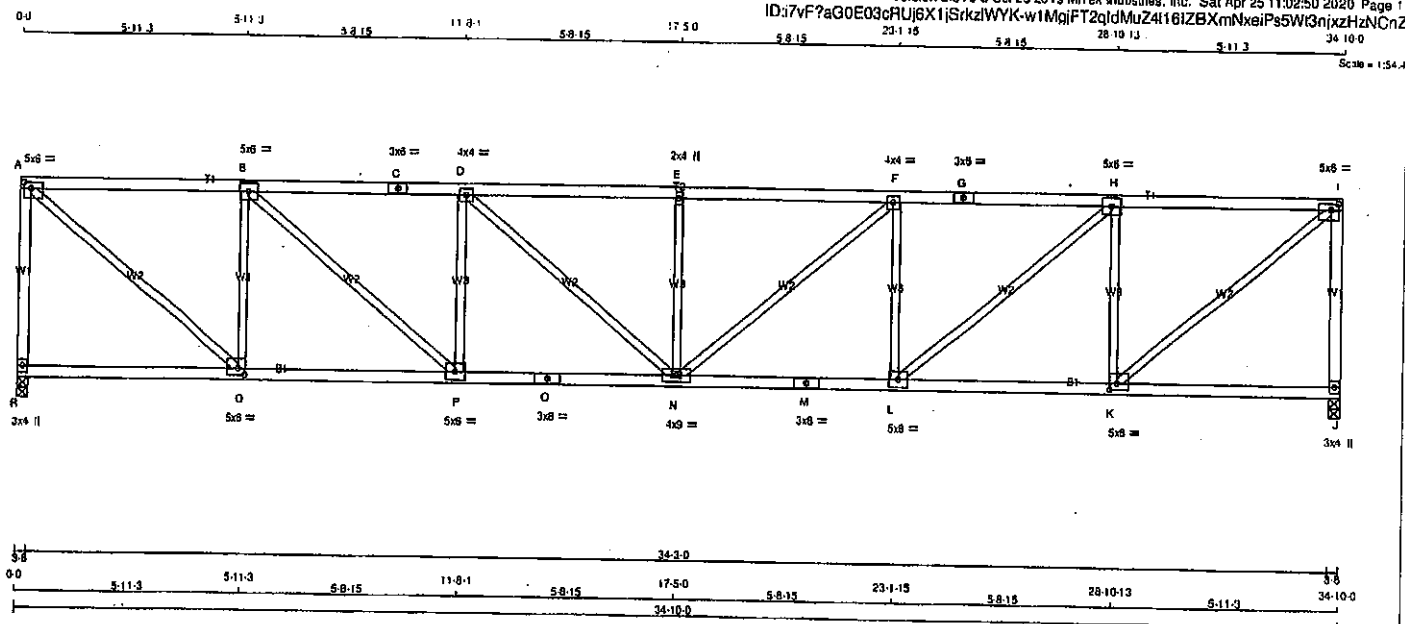

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
R - A	2x4	DRY No.2	SPF
A - C	2x4	DRY No.2	SPF
C - G	2x4	DRY No.2	SPF
G - I	2x4	DRY No.2	SPF
J - I	2x4	DRY No.2	SPF
R - O	2x4	DRY No.2	SPF
O - M	2x4	DRY No.2	SPF
M - J	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
DRY: SEASONED LUMBER.			

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWW-1	MT20	5.0	8.0	2.00	2.25
B	TS-1	MT20	3.0	8.0		
C	TS-1	MT20	3.0	8.0		
D	TMWW-1	MT20	4.0	4.0		
E	TMWW-1	MT20	2.0	4.0		
F	TMWW-1	MT20	4.0	4.0		
G	TS-1	MT20	3.0	8.0		
H	TMWW-1	MT20	5.0	6.0	2.00	2.25
I	TMWW-1	MT20	3.0	4.0		
J	BMV1+p	MT20	5.0	6.0	2.00	2.25
K	BMWW-1	MT20	5.0	6.0		
L	BMWW-1	MT20	5.0	6.0		
M	BS-1	MT20	3.0	8.0		
N	BMWW-1	MT20	4.0	9.0		
O	BS-1	MT20	3.0	8.0		
P	BMWW-1	MT20	5.0	6.0		
Q	BMWW-1	MT20	5.0	6.0	2.00	2.25
R	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT IN-SX	REQD IN-SX
	VERT	HORZ	DOWN	HORZ		
R	1920	0	1920	0	3-8	3-8
J	1920	0	1920	0	3-8	3-8

UNFACTORED REACTIONS

JT	1ST LGAGE COMBINED		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	SNOW	LIVE	PERM	LIVE			
R	1358	891 / 0	0 / 0	0 / 0	0 / 0	487 / 0	0 / 0
J	1358	891 / 0	0 / 0	0 / 0	0 / 0	487 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.23 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
R-A	-1875 / 0	0.0	0.0 0.83 (1)	8.13	K-I	0 / 2630	0.59 (1)
A-B	-2042 / 0	-91.8	-91.8 0.59 (1)	4.10	A-Q	0 / 2630	0.59 (1)
B-C	-3149 / 0	-91.8	-91.8 0.74 (1)	3.28	K-H	-1535 / 0	0.59 (1)
C-D	-3149 / 0	-91.8	-91.8 0.74 (1)	3.28	Q-B	-1535 / 0	0.59 (1)
D-E	-3533 / 0	-91.8	-91.8 0.68 (1)	3.23	L-H	0 / 1444	0.33 (1)
E-F	-3533 / 0	-91.8	-91.8 0.68 (1)	3.23	B-P	0 / 1444	0.33 (1)
F-G	-3149 / 0	-91.8	-91.8 0.74 (1)	3.28	L-F	-826 / 0	0.32 (1)
G-H	-3149 / 0	-91.8	-91.8 0.74 (1)	3.28	P-D	-826 / 0	0.32 (1)
H-I	-2042 / 0	-91.8	-91.8 0.59 (1)	4.10	N-F	0 / 502	0.11 (1)
I-J	-1875 / 0	0.0	0.0 0.83 (1)	8.13	D-N	0 / 502	0.11 (1)
R-Q	0 / 0	-18.5	-18.5 0.15 (4)	10.00	N-E	-537 / 0	0.21 (1)
Q-P	0 / 2042	-18.5	-18.5 0.40 (1)	10.00			
P-O	0 / 3149	-18.5	-18.5 0.59 (1)	10.00			
O-N	0 / 3149	-18.5	-18.5 0.59 (1)	10.00			
N-M	0 / 3149	-18.5	-18.5 0.59 (1)	10.00			
M-L	0 / 3149	-18.5	-18.5 0.59 (1)	10.00			
L-K	0 / 2042	-18.5	-18.5 0.40 (1)	10.00			
K-J	0 / 0	-18.5	-18.5 0.15 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.16')
CALCULATED VERT. DEFL. (LL) = L/999 (0.23')
ALLOWABLE DEFL. (TL) = L/360 (1.16')
CALCULATED VERT. DEFL. (TL) = L/998 (0.42')

CSI: TC=0.83/1.00 (A-R:1), BC=0.58/1.00 (N-P:1), WB=0.69/1.00 (K:1), SS=0.25/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY) (PS)	SHEAR (PL)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	818 354	1887 788

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (A) (INPUT = 0.90)
JSI METAL = 0.99 (M) (INPUT = 1.00)

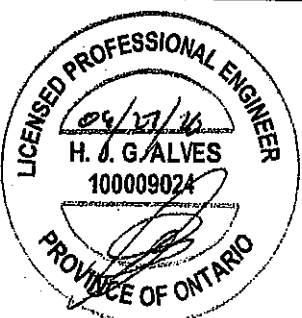

Structural component only
DWG# T-2007065

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408150	T3	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 11:02:51 2020 Page 1					
ID:7vF?ag0E03cRUj6X1jSrKzWYK-OEW2wbUhbclDWfxbqpkokJaK233bSy0IRTUVzNcN9Y					
Scale = 1/8" = 1'-0"					

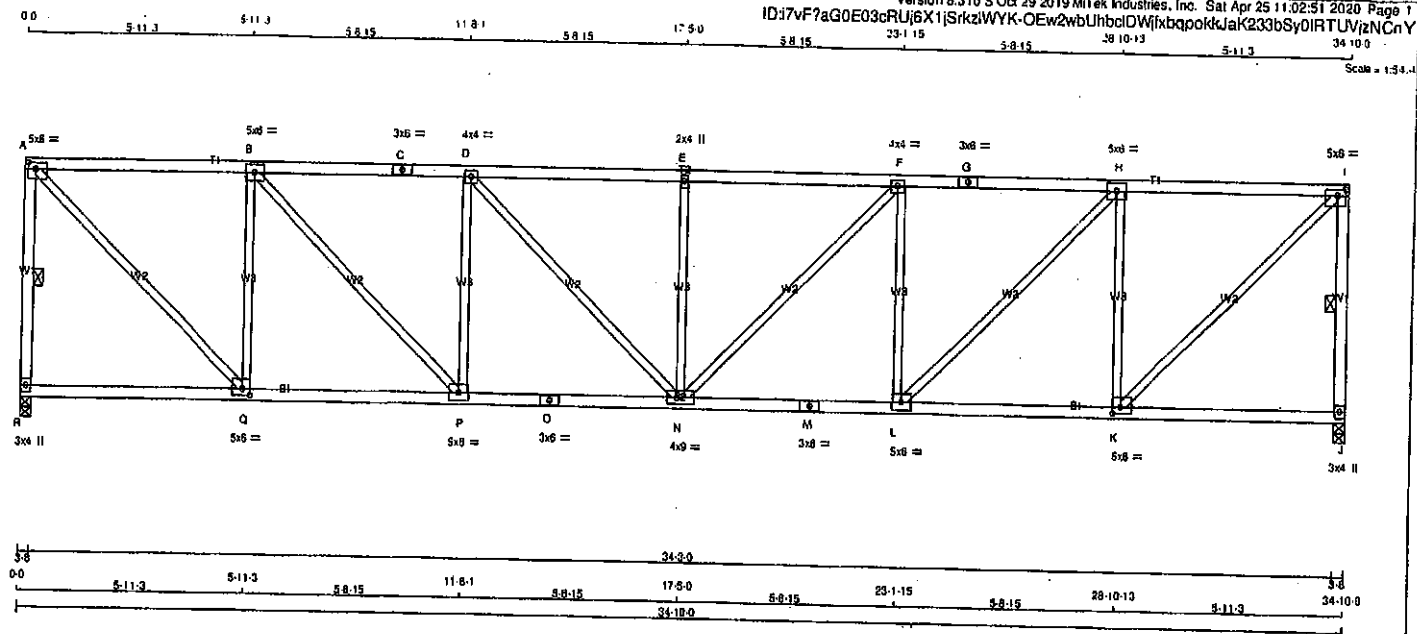

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
R - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
C - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - J	2x4	DRY	No.2
J - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS 2x3 DRY			
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW-1	MT20	5.0	6.0	2.00 2.50
B	TMVW-1	MT20	5.0	6.0	
C	TS-1	MT20	3.0	6.0	
D	TMVW-1	MT20	4.0	4.0	
E	TMVW-1	MT20	2.0	4.0	
F	TMVW-1	MT20	4.0	4.0	
G	TS-1	MT20	3.0	6.0	
H	TMVW-1	MT20	5.0	6.0	
I	TMVW-1	MT20	5.0	6.0	2.00 2.50
J	BMV1+p	MT20	3.0	4.0	
K	BMVW-1	MT20	5.0	6.0	2.00 2.50
L	BMVW-1	MT20	5.0	6.0	
M	BS-1	MT20	3.0	6.0	
N	BMVW-1	MT20	4.0	9.0	
O	BS-1	MT20	3.0	6.0	
P	BMVW-1	MT20	5.0	6.0	
Q	BMVW-1	MT20	5.0	6.0	2.00 2.50
R	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS									
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG					
R	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
J	1920	0	1920	0	0	3-8	3-8		
J	1920	0	1920	0	0	3-8	3-8		

UNFACTORED REACTIONS									
JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS							
R	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
J	1358	891 / 0	0 / 0	0 / 0	0 / 0	467 / 0	0 / 0		
J	1358	891 / 0	0 / 0	0 / 0	0 / 0	467 / 0	0 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.59 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-R, I-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS									
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRACED LENGTH	FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	FR-TO
R-A	-1875 / 0	0.0	0.0	0.33 (1)	4.90	K-I	0 / 2368	0.53 (1)	
A-B	-1891 / 0	-91.8	-91.8	0.55 (1)	4.46	A-Q	0 / 2368	0.53 (1)	
B-C	-2608 / 0	-91.8	-91.8	0.66 (1)	3.63	K-H	-1538 / 0	0.90 (1)	
C-D	-2608 / 0	-91.8	-91.8	0.66 (1)	3.63	Q-B	-1538 / 0	0.90 (1)	
D-E	-2927 / 0	-91.8	-91.8	0.58 (1)	3.59	L-H	0 / 1304	0.29 (1)	
E-F	-2927 / 0	-91.8	-91.8	0.58 (1)	3.59	B-P	0 / 1304	0.29 (1)	
F-G	-2608 / 0	-91.8	-91.8	0.66 (1)	3.63	L-F	-826 / 0	0.48 (1)	
G-H	-2608 / 0	-91.8	-91.8	0.66 (1)	3.63	P-D	-826 / 0	0.48 (1)	
H-I	-1891 / 0	-91.8	-91.8	0.55 (1)	4.46	N-F	0 / 453	0.10 (1)	
I-J	-1875 / 0	0.0	0.0	0.33 (1)	4.90	D-N	0 / 453	0.10 (1)	
R-Q	0 / 0	-18.5	-18.5	0.15 (4)	10.00	N-E	-537 / 0	0.31 (1)	
Q-P	0 / 1691	-18.5	-18.5	0.35 (1)	10.00				
P-O	0 / 2608	-18.5	-18.5	0.47 (1)	10.00				
O-N	0 / 2608	-18.5	-18.5	0.47 (1)	10.00				
N-M	0 / 2608	-18.5	-18.5	0.47 (1)	10.00				
M-L	0 / 2608	-18.5	-18.5	0.47 (1)	10.00				
L-K	0 / 1691	-18.5	-18.5	0.35 (1)	10.00				
K-J	0 / 0	-18.5	-18.5	0.15 (4)	10.00				

TOTAL WEIGHT = 2 X 153 = 306 lb

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCG 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.18")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.33")

CSK: TC=0.88/1.00 (F-H:1), BC=0.47/1.00 (N-P:1), WB=0.90/1.00 (H-K:1), SSI=0.25/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	818 354	1867 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP=0.88 (I) (INPUT = 0.90)

JSI METAL=0.83 (M) (INPUT = 1.00)

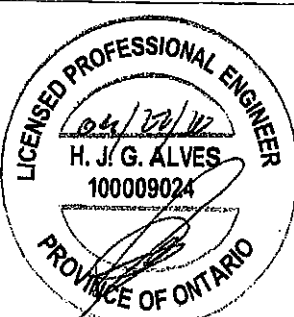

Structural component only
DWG# T-2007066

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408150	T4	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

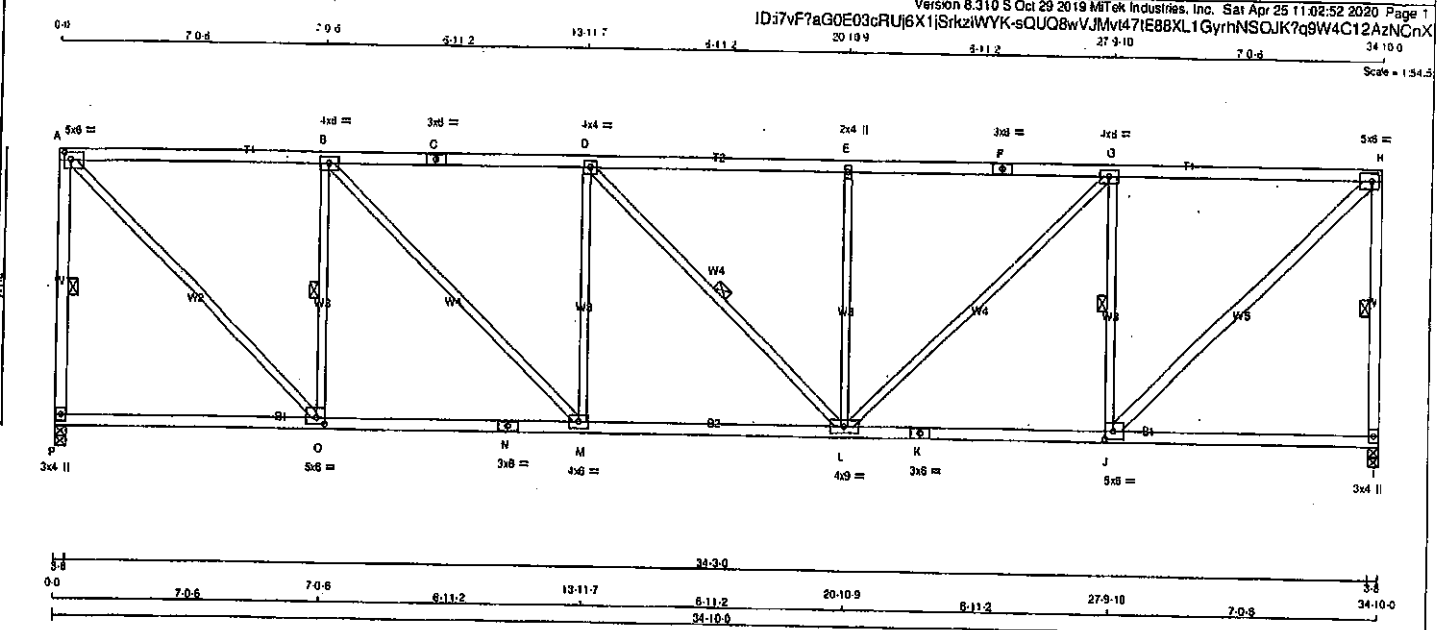

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER P - A 2x4 DRY No.2 A - C 2x4 DRY No.2 C - F 2x4 DRY No.2 F - H 2x4 DRY No.2 I - H 2x4 DRY No.2 P - N 2x4 DRY No.2 N - K 2x4 DRY No.2 K - I 2x4 DRY No.2 ALL WEBS 2x3 DRY No.2 EXCEPT J - H 2x4 DRY No.2 DRY: SEASONED LUMBER.				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 25.8 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015 - THIS DESIGN COMPLIES WITH: - PART 9 OF CBC 2018, OBC 2012, ABC 2019 - PART 9 OF OBC 2012 (2019 AMENDMENT) - CSA 088-09, CSA 088-14 - TPIC 2011, TPIC 2014 (55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL) = L/360 (1.16") CALCULATED VERT. DEFL.(LL) = L/999 (0.15") ALLOWABLE DEFL.(TL) = L/360 (1.16") CALCULATED VERT. DEFL.(TL) = L/999 (0.29") CSI: TC=0.96/1.00 (E-G:1), BC=0.47/1.00 (L-M:1), WB=0.54/1.00 (D-H:1), SSI=0.30/1.00 (G-H:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10 COMPANION LIVE LOAD FACTOR = 1.00 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 818 354 1667 788 1987 1666 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP = 0.90 (A) (INPUT = 0.90) JSI METAL = 0.53 (K) (INPUT = 1.00)			
PLATES (table in inches) JT TYPE PLATES W LEN Y X A TMVW-1 MT20 5.0 8.0 2.25 2.00 B TMVW-1 MT20 4.0 8.0 C TS-1 MT20 3.0 8.0 D TMVW-1 MT20 4.0 4.0 E TMVW-1 MT20 2.0 4.0 F TS-1 MT20 3.0 8.0 G TMVW-1 MT20 4.0 8.0 H TMVW-1 MT20 5.0 8.0 2.50 2.50 I BMV1+p MT20 3.0 4.0 J BMVW-1 MT20 3.0 4.0 2.50 2.50 K BS-1 MT20 3.0 8.0 L BMVW-1 MT20 4.0 8.0 M BMVW-1 MT20 4.0 8.0 N BS-1 MT20 3.0 8.0 O BMVW-1 MT20 5.0 8.0 2.00 2.50 P BMV1+p MT20 3.0 4.0				BEARINGS FACTORED GROSS REACTION MAXIMUM FACTORED GROSS REACTION INPUT REQD JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX P 1920 0 1920 0 0 3-8 3-8 I 1920 0 1920 0 0 3-8 3-8 UNFACTORED REACTIONS 1ST CASE MAX/MIN COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL P 1358 881/0 0/0 0/0 0/0 467/0 0/0 I 1358 881/0 0/0 0/0 0/0 467/0 0/0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.31 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED. 1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-P, H-I, B-O, D-L, G-J. END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW LOADING TOTAL LOAD CASES: (4) CHORDS MAX. FACTORED MEMB. FORCE (LBS) FACTORED VERT. LOAD (PLF) MAX. FACTORED VERT. LOAD (PLF) MAX. FACTORED VERT. LOAD (PLF) MAX. FACTORED VERT. LOAD (PLF) FR-TO FROM TO LENGTH FR-TO FROM TO LENGTH FR-TO FROM TO LENGTH FR-TO FROM TO LENGTH P-A -1888/0 0.0 0.0 0.43 (1) 4.81 A-O 0/2315 0.52 (1) A-B -1662/0 -91.8 -91.8 0.82 (1) 4.04 O-B -1466/0 0.47 (1) B-C -2416/0 -91.8 -91.8 0.95 (1) 3.33 B-M 0/1068 0.24 (1) C-D -2416/0 -91.8 -91.8 0.95 (1) 3.33 M-D -817/0 0.54 (1) D-E -2416/0 -91.8 -91.8 0.74 (1) 3.73 D-L -2/0 0.00 (1) E-F -2416/0 -91.8 -91.8 0.96 (1) 3.31 L-E -616/0 0.54 (1) F-G -2416/0 -91.8 -91.8 0.96 (1) 3.31 L-G 0/1054 0.24 (1) G-H -1663/0 -91.8 -91.8 0.82 (1) 4.02 J-G -1465/0 0.47 (1) H-I -1888/0 0.0 0.0 0.43 (1) 4.91 J-H 0/2316 0.37 (1) P-O 0/0 -18.5 -18.5 0.22 (4) 10.00 O-N 0/1662 -18.5 -18.5 0.39 (1) 10.00 N-M 0/1662 -18.5 -18.5 0.39 (1) 10.00 M-L 0/2416 -18.5 -18.5 0.47 (1) 10.00 L-K 0/1663 -18.5 -18.5 0.39 (1) 10.00 K-J 0/1663 -18.5 -18.5 0.39 (1) 10.00 J-I 0/0 -18.5 -18.5 0.22 (4) 10.00			




Structural component only
DWG# T-2007067

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408150	T5	10	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Sat Apr 25 11:02:53 2020 Page 1
ID:7vF?aG0E03cRUj8X1jSrkzIWK-Kc2pLGWx7D7x10pKfGp9Os5sl3ONJlkybaezNCnW
34-9-9 34-10-1
34-9-9 34-10-1
Scale = 1:54.5

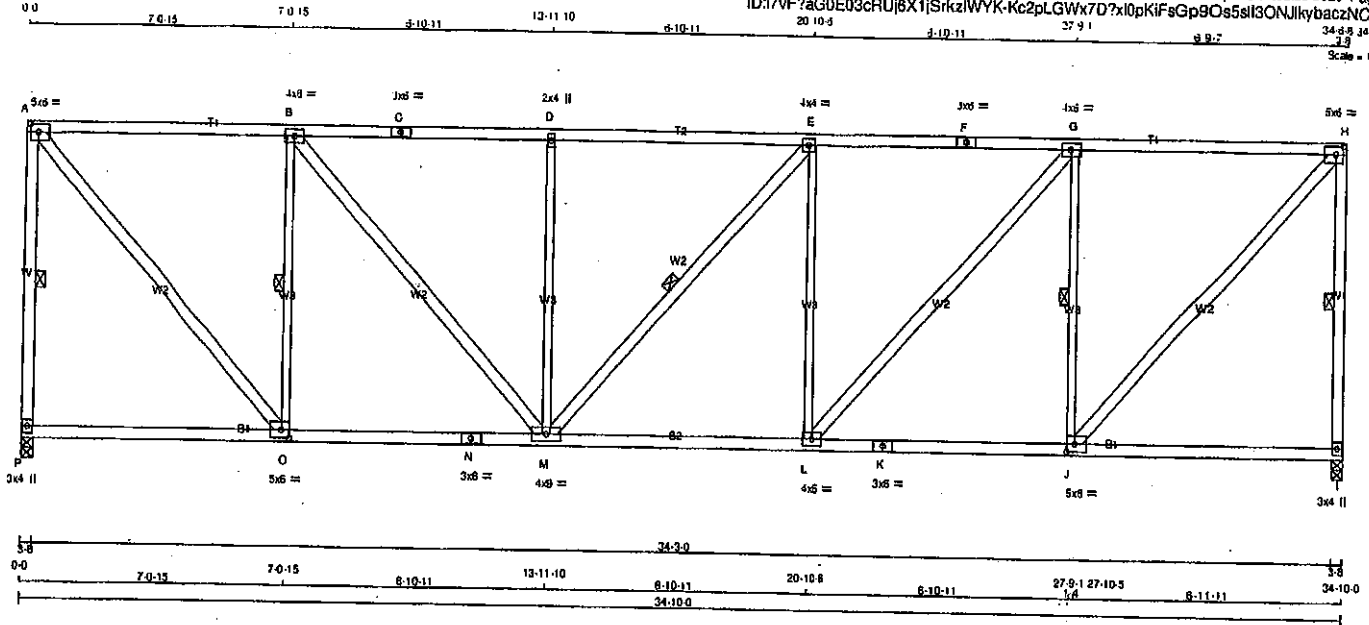

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
P - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
I - H	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
ALL WEBS EXCEPT	2x4	DRY	No.2
J - G	2x3	DRY	No.2
O - B	2x3	DRY	No.2
L - E	2x3	DRY	No.2
M - D	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)					
JT TYPE	PLATES	W	LEN	Y	X
A	TMWV-1	MT20	5.0	6.0	2.50 2.50
B	TMWV-1	MT20	4.0	6.0	
C	TS-1	MT20	3.0	6.0	
D	TMWV-1	MT20	2.0	4.0	
E	TS-1	MT20	4.0	4.0	
F	TMWV-1	MT20	3.0	6.0	
G	TMWV-1	MT20	4.0	6.0	
H	TMWV-1	MT20	5.0	6.0	2.50 2.50
I	BMV1-p	MT20	3.0	4.0	
J	BMWV-1	MT20	5.0	6.0	2.50 2.50
K	BS-1	MT20	3.0	6.0	
L	BMWV-1	MT20	4.0	6.0	
M	BMWV-1	MT20	4.0	6.0	
N	BS-1	MT20	3.0	6.0	
O	BMWV-1	MT20	5.0	6.0	2.50 2.50
P	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	FACTORED GROSS REACTION	VERT	HORIZ	MAXIMUM FACTORED GROSS REACTION	DOWN	UPLIFT	INPUT BRG IN-SX
P	1920	0	0	1920	0	0	3-8
I	1920	0	0	1920	0	0	3-8

UNFACTORED REACTIONS							
JT	1ST CASE COMBINED	MAX. MIN. SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
P	1358	891 / 0	0 / 0	0 / 0	0 / 0	467 / 0	0 / 0
I	1358	891 / 0	0 / 0	0 / 0	0 / 0	467 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.56 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-P, H-I, G-J, B-O, E-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING			
TOTAL LOAD CASES: (4)			
CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)
P-A	-1888 / 0	0.0	0.0 0.55 (1)
A-B	-1458 / 0	-91.8	-91.8 0.80 (1)
B-C	-2108 / 0	-91.8	-91.8 0.90 (1)
C-D	-2108 / 0	-91.8	-91.8 0.90 (1)
D-E	-2108 / 0	-91.8	-91.8 0.68 (1)
E-F	-2108 / 0	-91.8	-91.8 0.90 (1)
F-G	-2108 / 0	-91.8	-91.8 0.90 (1)
G-H	-1458 / 0	-91.8	-91.8 0.79 (1)
H-I	-1888 / 0	0.0	0.0 0.55 (1)
P-O	0 / 0	-18.5	-18.5 0.22 (4)
O-N	0 / 1458	-18.5	-18.5 0.36 (1)
N-M	0 / 1458	-18.5	-18.5 0.36 (1)
M-L	0 / 2108	-18.5	-18.5 0.42 (1)
L-K	0 / 1458	-18.5	-18.5 0.36 (1)
K-J	0 / 1458	-18.5	-18.5 0.36 (1)
J-I	0 / 0	-18.5	-18.5 0.22 (4)

WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. FACTORED FORCE (LBS)
J-H	0 / 2171	0.35 (1)	0.35 (1)
A-O	0 / 2171	0.35 (1)	0.35 (1)
J-G	-1463 / 0	0.81 (1)	0.81 (1)
O-B	-1462 / 0	0.81 (1)	0.81 (1)
L-G	0 / 982	0.16 (1)	0.16 (1)
B-M	0 / 980	0.16 (1)	0.16 (1)
L-E	-613 / 0	0.78 (1)	0.78 (1)
M-D	-612 / 0	0.77 (1)	0.77 (1)
M-E	-2 / 0	0.00 (1)	0.00 (1)

TOTAL WEIGHT = 10 X 178 = 1785 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.90/1.00 (B-D:1), BC=0.42/1.00 (L-M:1),
WB=0.78/1.00 (E-L:1), SS=0.31/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (A) (INPUT = 0.90)
JSI METAL = 0.47 (N) (INPUT = 1.00)




Structural component only
DWG# T-2007068

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408150	T6	1	1	TRUSS DESC.		

Famarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 11:02:54 2020 Page 1
ID:7vF7aG0E03cRUj6X1jSrkzIWK-opcBZcXZuX7cNAOWGyNVLNxAAG1Foy0S_Oh862zNCnV

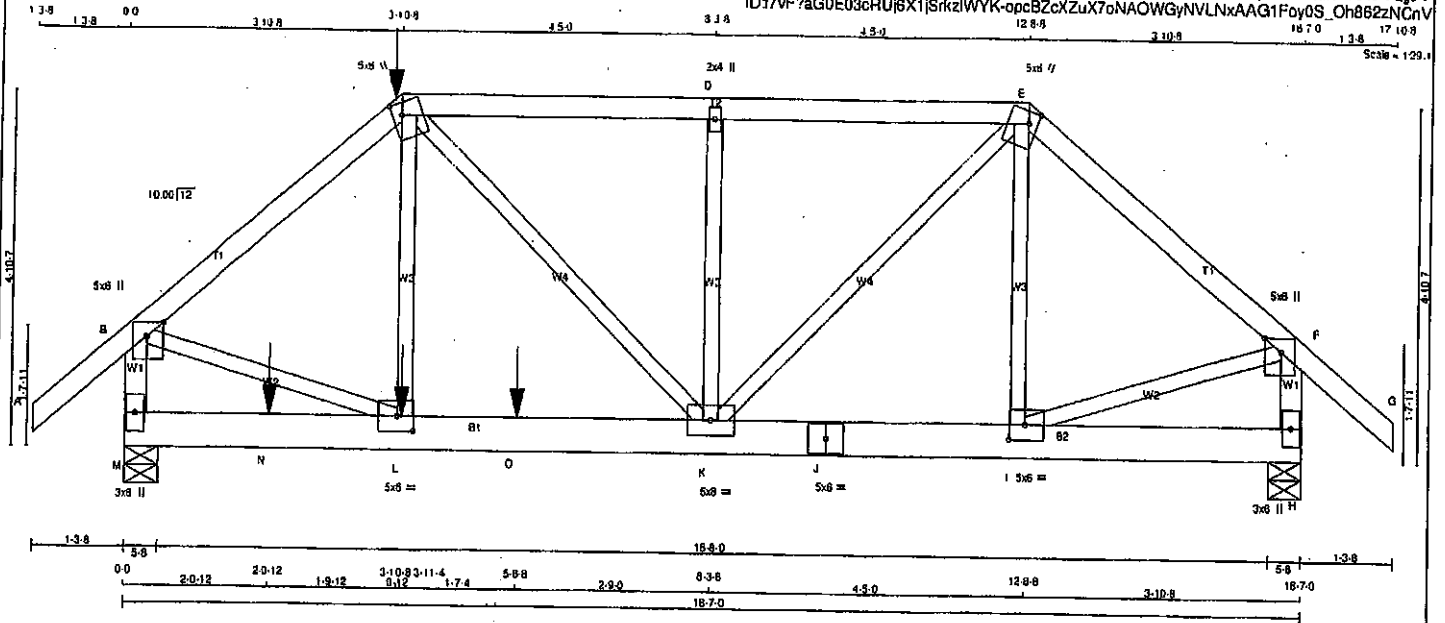

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No. 2	
C - E	2x4	DRY	No. 2	
E - G	2x4	DRY	No. 2	
G - H	2x4	DRY	No. 2	
H - J	2x4	DRY	No. 2	
J - K	2x4	DRY	No. 2	
K - L	2x4	DRY	No. 2	
L - M	2x4	DRY	No. 2	
M - N	2x4	DRY	No. 2	
N - O	2x4	DRY	No. 2	
O - P	2x4	DRY	No. 2	
P - Q	2x4	DRY	No. 2	

ALL WEBS 2x3 DRY No. 2

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	Edge	2.75
C	TTWW+m	MT20	5.0	6.0	2.00	1.50
D	TMVW+m	MT20	2.0	4.0		
E	TTWW+m	MT20	5.0	6.0	2.00	1.50
F	TMVW+p	MT20	5.0	6.0	Edge	2.75
H	BMV1+p	MT20	3.0	6.0		
I	BMVW-t	MT20	5.0	6.0	2.50	2.75
J	BS-t	MT20	5.0	6.0		
K	BMVW-t	MT20	5.0	6.0		
L	BMVW-t	MT20	5.0	6.0	2.50	2.75
M	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	UP/LIFT
M	1888	0	0	5-8
H	1422	0	0	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
M	1329	909 / 0	0 / 0	0 / 0	0 / 0	420 / 0	0 / 0
H	1001	683 / 0	0 / 0	0 / 0	0 / 0	318 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.55 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED HORZ. LOAD (LBS)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED HORZ. LOAD (LBS)
FR-TO					FR-TO			
A-B	0 / 41	-91.8	-91.8	0.14 (1)	10.00	L-C	0 / 383	0.09 (1)
B-C	-1847 / 0	-91.8	-91.8	0.34 (1)	4.55	C-K	0 / 316	0.08 (1)
C-D	-1841 / 0	-91.8	-91.8	0.38 (1)	4.72	K-D	-481 / 0	0.18 (1)
D-E	-1841 / 0	-91.8	-91.8	0.38 (1)	4.72	K-E	0 / 1010	0.25 (1)
E-F	-1225 / 0	-91.8	-91.8	0.30 (1)	5.40	I-E	-274 / 0	0.09 (1)
F-G	0 / 41	-91.8	-91.8	0.14 (1)	10.00	B-L	0 / 1480	0.37 (1)
G-H	-1928 / 0	0.0	0.0	0.22 (1)	6.01	I-F	0 / 981	0.24 (1)
H-F	-1380 / 0	0.0	0.0	0.16 (1)	6.88			
M-N	0 / 0	-18.5	-18.5	0.24 (1)	10.00			
N-L	0 / 0	-18.5	-18.5	0.24 (1)	10.00			
L-O	0 / 1424	-18.5	-18.5	0.70 (1)	10.00			
O-K	0 / 1424	-18.5	-18.5	0.70 (1)	10.00			
K-J	0 / 932	-18.5	-18.5	0.29 (1)	10.00			
J-I	0 / 932	-18.5	-18.5	0.29 (1)	10.00			
I-H	0 / 0	-18.5	-18.5	0.04 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	3-10-8	-241	-241	---	FRONT	VERT	TOTAL	---	C1
L	3-11-4	-17	-17	---	FRONT	VERT	TOTAL	---	C1
N	2-0-12	-17	-17	---	FRONT	VERT	TOTAL	---	C1
O	5-6-8	-953	-953	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 84 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, OBC 2012, ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.55")
CALCULATED VERT. DEFL.(LL) = L/899 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.55")
CALCULATED VERT. DEFL.(TL) = L/899 (0.10")

CSI: TC=0.38/1.00 (C-D:1), BC=0.70/1.00 (K-L:1), WB=0.37/1.00 (B-L:1), SSI=0.45/1.00 (K-L:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PL)
MT20	618	354	1867
	788	1907	1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.89 (C) (INPUT = 0.90)
JSI METAL = 0.57 (J) (INPUT = 1.00)



Structural component only
DWG# T-2007089

JOB NAME 408150	TRUSS NAME 17	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Metek Industries, Inc. Sat Apr 25 11:02:55 2020 Page 1
ID:7vF7aG0E03cRUj8X1iSrkzWYK-G7AZmyXBqFi_KyqghukuaTK3fVZXS_cD2RiiVzNCnU

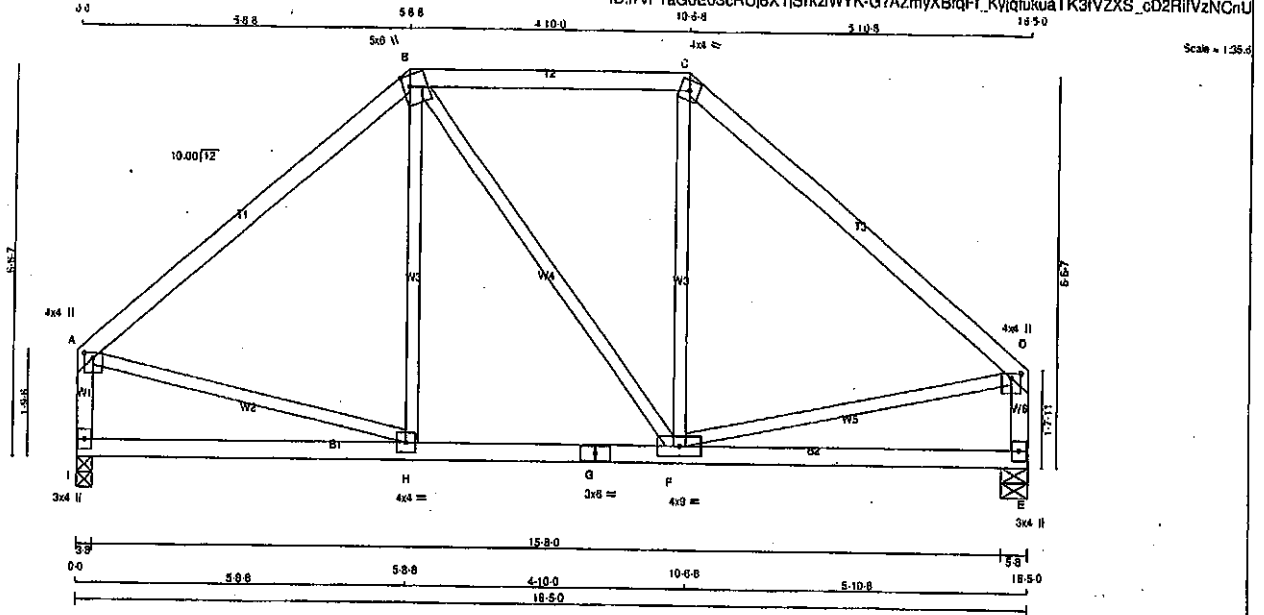

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - B	2x4 DRY	No.2	SPF
B - C	2x4 DRY	No.2	SPF
C - D	2x4 DRY	No.2	SPF
I - A	2x4 DRY	No.2	SPF
E - D	2x4 DRY	No.2	SPF
I - G	2x4 DRY	No.2	SPF
G - E	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW+p	MT20	4.0	4.0	1.00 2.00
B	TTWW+m	MT20	5.0	6.0	2.25 1.50
C	TTW-m	MT20	4.0	4.0	
D	TMVW+p	MT20	4.0	4.0	1.00 2.00
E	BMV1+p	MT20	3.0	4.0	
F	BMVWW-t	MT20	4.0	9.0	
G	BS-t	MT20	3.0	6.0	
H	BMVW-t	MT20	4.0	4.0	
I	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	HORIZ	GROSS REACTION	DOWN	HORIZ	BRG	IN-SX	BRG	IN-SX
I	905	0	905	0	0	3-8	3-8		
E	905	0	905	0	0	5-8	5-8		

UNFACTORED REACTIONS		1ST LCASE		MAX/MIN COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
I	840	420/0	0/0	0/0	0/0
E	840	420/0	0/0	0/0	220/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I, E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (LC)	MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	-718/0	-91.8	-91.8 0.39 (1)	H-B	-34/68	0.02 (4)	
B-C	-558/0	-91.8	-91.8 0.28 (1)	B-F	0/14	0.00 (1)	
C-D	-729/0	-91.8	-91.8 0.42 (1)	F-C	-23/74	0.03 (4)	
I-A	-880/0	0.0	0.0 0.09 (1)	A-H	0/567	0.13 (1)	
E-D	-858/0	0.0	0.0 0.09 (1)	F-D	0/572	0.13 (1)	
I-H	0/0	-18.5	-18.5 0.13 (4)				
H-G	0/550	-18.5	-18.5 0.18 (4)				
G-F	0/550	-18.5	-18.5 0.18 (4)				
F-E	0/0	-18.5	-18.5 0.14 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 085-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.55")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.55")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.421/0.0 (C-D), BC=0.18/1.00 (F-H), WS=0.13/1.00 (D-F), SS=0.17/1.00 (B-C)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (D) (INPUT = 0.90)
JSI METAL = 0.24 (D) (INPUT = 1.00)




Structural component only
DWG# T-2007070

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408150	T8	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:02:58 2020 Page 1
ID:17vF7aG0E03cRUj6X1S/kzWYK-iBkxziYpQ8NWcUXvNNPzRo0Y13nGGpIIRiAFBxzNCnT

Scale = 1:43.9

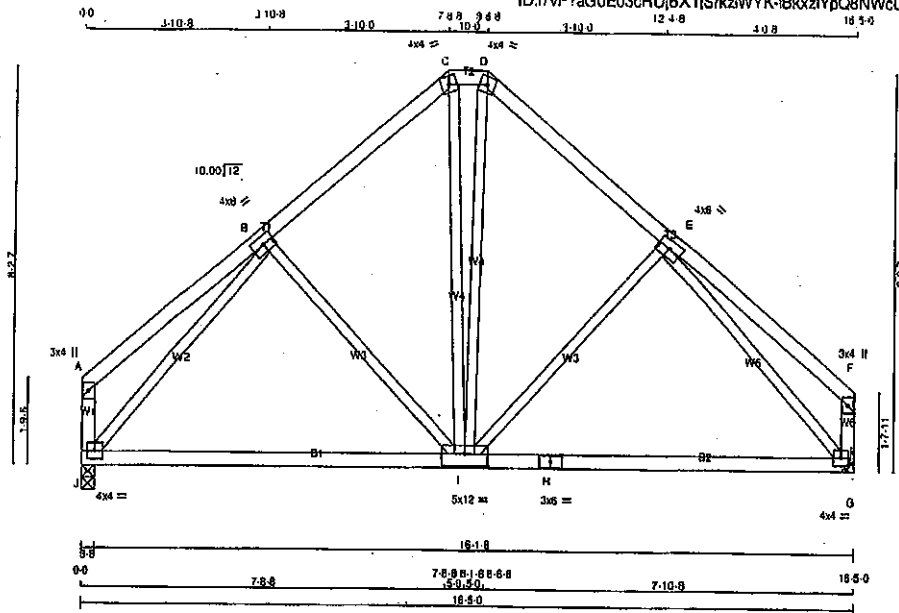

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE		LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
J - A	2x4	DRY	No.2
G - F	2x4	DRY	No.2
J - H	2x4	DRY	No.2
H - G	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B	TMWW-1	MT20	4.0	6.0		
C	TTW-m	MT20	4.0	4.0		
D	TTW-m	MT20	4.0	4.0		
E	TMWW-1	MT20	4.0	6.0		
F	TMV+p	MT20	3.0	4.0		
G	BMVW1-1	MT20	4.0	4.0		
H	BS-1	MT20	3.0	6.0		
I	BMVWW-1	MT20	5.0	12.0	3.00	6.00
J	BMVW1-1	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	UP	IN-SX
J	905	0	0	3-8
G	905	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

1ST CASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED SNOW LIVE PERM LIVE WIND DEAD SOIL
J	640 420/0 0/0 0/0 0/0 220/0 0/0
G	640 420/0 0/0 0/0 0/0 220/0 0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO									
A-B	0/27	-91.8	-91.8	0.22 (1)	10.00	8-1	-163/0	0.11 (1)	
B-C	-649/0	-91.8	-91.8	0.17 (1)	6.25	I-E	-190/0	0.13 (1)	
C-D	-489/0	-91.8	-91.8	0.01 (1)	6.25	J-B	-830/0	0.54 (1)	
D-E	-650/0	-91.8	-91.8	0.18 (1)	6.25	E-G	-935/0	0.57 (1)	
E-F	0/27	-91.8	-91.8	0.23 (1)	10.00	C-I	0/221	0.05 (1)	
J-A	-129/0	0.0	0.0	0.01 (1)	7.81	I-D	0/222	0.05 (1)	
G-F	-137/0	0.0	0.0	0.01 (1)	7.81				
J-I	0/590	-18.5	-18.5	0.41 (4)	10.00				
I-H	0/608	-18.5	-18.5	0.41 (4)	10.00				
H-G	0/608	-18.5	-18.5	0.41 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.F. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.65")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.65")
CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CSI: TC=0.23/1.00 (E-F:1), BC=0.41/1.00 (G-I:4), WB=0.57/1.00 (E-G:1), SS=0.13/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.75 (G) (INPUT = 0.90)
JSI METAL= 0.23 (G) (INPUT = 1.00)



Structural component only
DWG# T-2007071

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408150	T9	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

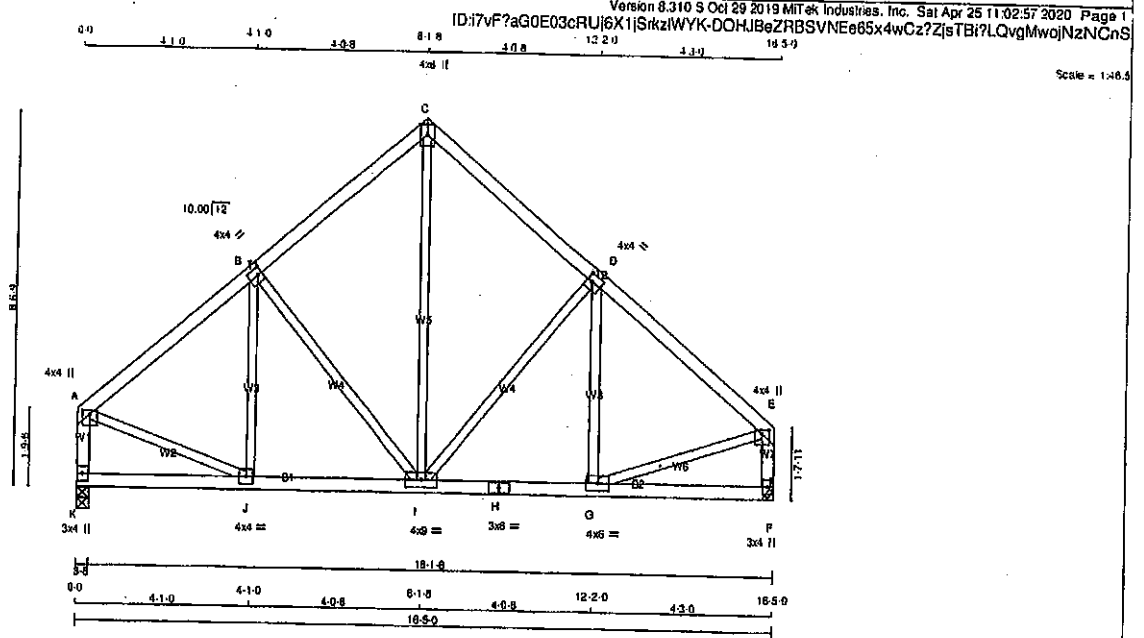

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
K - A	2x4	DRY	No.2
F - E	2x4	DRY	No.2
K - H	2x4	DRY	No.2
H - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
A - TMVW+p	MT20	4.0	4.0	1.00	2.00
B - TMVW-l	MT20	4.0	4.0	2.00	1.25
C - TTW+p	MT20	4.0	8.0	Edge	
D - TMVW-l	MT20	4.0	4.0	2.00	1.25
E - TMVW+p	MT20	4.0	4.0	1.00	2.00
F - BMV1+p	MT20	3.0	4.0		
G - BMVW-l	MT20	4.0	8.0		
H - BS-l	MT20	3.0	6.0		
I - BMVW-l	MT20	4.0	9.0		
J - BMVW-l	MT20	4.0	4.0		
K - BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
K	905	0	905	0	3-8
F	905	0	905	0	3-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERALIVE	WIND	DEAD	SOIL
K	640	420 / 0	0 / 0	0 / 0	0 / 0	220 / 0	0 / 0
F	640	420 / 0	0 / 0	0 / 0	0 / 0	220 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	-772 / 0	-91.8 -91.8	0.20 (1)	J-B	-135 / 21	0.05 (1)	
B-C	-620 / 0	-91.8 -91.8	0.19 (1)	B-I	-251 / 0	0.18 (1)	
C-D	-622 / 0	-91.8 -91.8	0.20 (1)	I-C	0 / 478	0.11 (1)	
D-E	-795 / 0	-91.8 -91.8	0.21 (1)	I-D	-278 / 0	0.20 (1)	
K-A	-873 / 0	0.0 0.0	0.10 (1)	G-D	-110 / 31	0.04 (1)	
F-E	-872 / 0	0.0 0.0	0.09 (1)	A-J	0 / 653	0.15 (1)	
				G-E	0 / 662	0.15 (1)	
K-J	0 / 0	-18.5 -18.5	0.07 (4)				
J-I	0 / 615	-18.5 -18.5	0.13 (1)				
I-H	0 / 633	-18.5 -18.5	0.14 (1)				
H-G	0 / 633	-18.5 -18.5	0.14 (1)				
G-F	0 / 0	-18.5 -18.5	0.07 (4)				

TOTAL WEIGHT = 77 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 6.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.55")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.55")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.21/1.00 (D-E:1), BC=0.14/1.00 (G-I:1), WB=0.20/1.00 (D-I:1), SSI=0.14/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.87 (E) (INPUT = 0.90)
JSI METAL= 0.24 (E) (INPUT = 1.00)




Structural component only
DWG# T-2007072

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408150	T10S	2	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:02:58 2020 Page 1
ID:7VF7aG0E03cRUJ8X1jSkziWYK-hanO_a4yldDrohiVoRRWD5vyIX_kqu2v0IMfpzNCnR

Scale = 1/32"

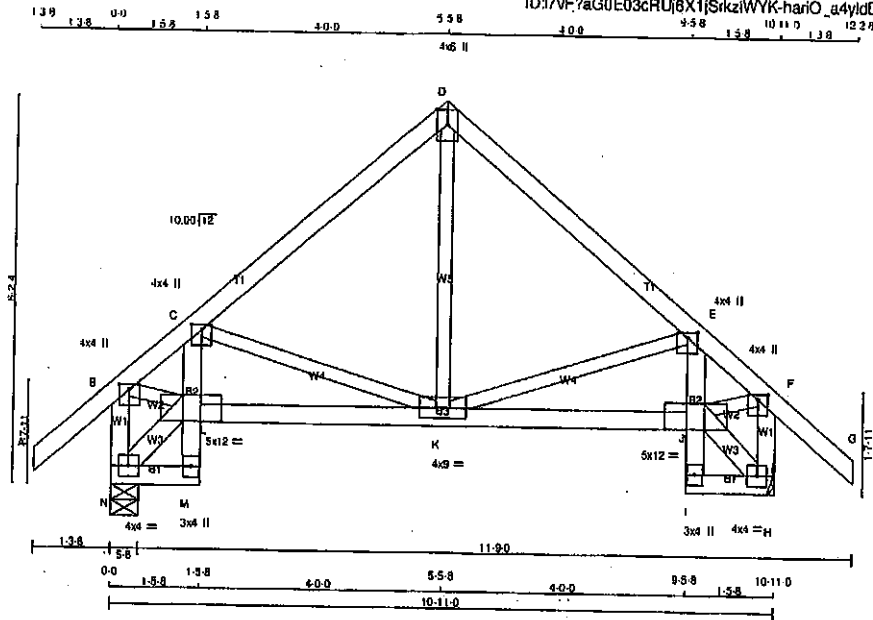

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2		
D - B	2x4	DRY	No.2		
N - B	2x4	DRY	No.2		
H - F	2x4	DRY	No.2		
N - M	2x4	DRY	No.2		
M - C	2x4	DRY	No.2		
L - J	2x4	DRY	No.2		
I - E	2x4	DRY	No.2		
I - H	2x4	DRY	No.2		

ALL WEBS	2x4	DRY	No.2
EXCEPT			
N - L	2x4	DRY	No.2
J - H	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B, C, E, F					
B	MTW+p	MT20	4.0	4.0	1.00 2.00
D	TTW+p	MT20	4.0	8.0	Edge
H	BMVW1-i	MT20	4.0	4.0	
I	BMV+p	MT20	3.0	4.0	
J	BMVWV1-i	MT20	5.0	12.0	5.00 7.75
K	BMVWV1-i	MT20	4.0	9.0	
L	BMVWV1-i	MT20	5.0	12.0	5.00 7.75
M	BMV+p	MT20	3.0	4.0	
N	BMVW1-i	MT20	4.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
N	729	0	729	0
H	729	0	729	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 1-8.

UNFACTORED REACTIONS

1ST LOSE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
N	513	350/0 0/0 0/0 0/0 163/0 0/0
H	513	350/0 0/0 0/0 0/0 163/0 0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED			WEBS		
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LO1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX FACTORED CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0/41	-91.8	-91.8 0.13 (1)	10.00	C-K	-211/0	0.07 (1)
B-C	-847/0	-91.8	-91.8 0.14 (1)	8.25	K-D	0/229	0.05 (1)
C-D	-447/0	-91.8	-91.8 0.15 (1)	8.25	K-E	-210/0	0.07 (1)
D-E	-447/0	-91.8	-91.8 0.16 (1)	8.25	N-L	-26/0	0.00 (1)
E-F	-846/0	-91.8	-91.8 0.14 (1)	8.25	B-L	0/527	0.12 (1)
F-G	0/41	-91.8	-91.8 0.13 (1)	10.00	J-F	0/526	0.12 (1)
N-B	-701/0	0.0	0.0 0.07 (1)	7.81	J-H	-26/0	0.00 (1)
H-F	-701/0	0.0	0.0 0.07 (1)	7.81			
N-M	0/20	-18.5	-18.5 0.01 (4)	10.00			
M-L	0/14	0.0	0.0 0.03 (1)	10.00			
L-C	-92/2	0.0	0.0 0.02 (1)	7.81			
L-K	0/528	-18.5	-18.5 0.13 (1)	10.00			
K-J	0/527	-18.5	-18.5 0.13 (1)	10.00			
I-J	0/14	0.0	0.0 0.03 (1)	10.00			
J-E	-93/2	0.0	0.0 0.02 (1)	7.81			
I-H	0/20	-18.5	-18.5 0.01 (4)	10.00			

TOTAL WEIGHT = 2 X 58 = 112 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ASQ 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.38")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.38")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")
CSI: TO=0.19/1.00 (C-D:1), BC=0.13/1.00 (K-L:1), WB=0.12/1.00 (B-L:1), S91=0.13/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1887 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.74 (F) (INPUT = 0.90)
JSI METAL = 0.20 (F) (INPUT = 1.00)

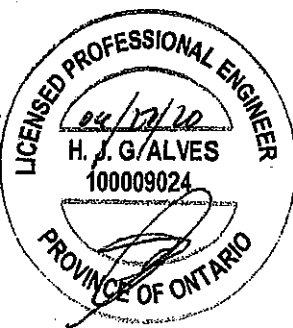

Structural component only
DWG# T-2007073

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408150	T11	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
TRUSS DESC.					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:02:59 2020 Page 1
ID:17vF7aG0E03cRUj8X1jSkziWYK-9mP4cKaj3l4TxGU3Vzq2Qe15HssTHxB7gPvoGzNCnQ

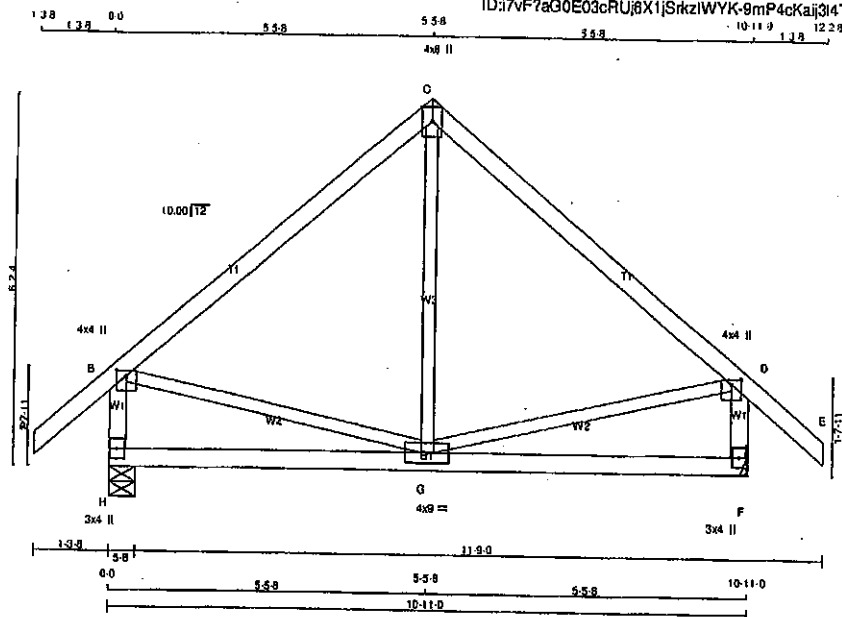

Scale = 1/32"

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
F - D	2x4	DRY	No.2
H - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00
C TTW+p	MT20	4.0	6.0	Edge	
D TMVW+p	MT20	4.0	4.0	1.00	2.00
F BMV1+p	MT20	3.0	4.0		
G BMVWW-1	MT20	4.0	9.0		
H BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	GROSS REACTION	GROSS REACTION	GROSS REACTION	BRG	BRG	BRG	BRG	IN-SX	IN-SX
H	729	0	729	0	0	5-8	5-8		
F	729	0	729	0	0	MECHANICAL	MECHANICAL		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
H	513	350/0	0/0	0/0	163/0	0/0
F	513	350/0	0/0	0/0	163/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0/41	-91.8 -91.8	0.13 (1)	10.00	G-C	-15/89	0.03 (4)
B-C	-380/0	-91.8 -91.8	0.35 (1)	6.25	B-G	0/300	0.07 (1)
C-D	-380/0	-91.8 -91.8	0.35 (1)	6.25	G-D	0/300	0.07 (1)
D-E	0/41	-91.8 -91.8	0.13 (1)	10.00			
H-B	-690/0	0.0 0.0	0.07 (1)	7.81			
F-D	-690/0	0.0 0.0	0.07 (1)	7.81			
H-G	0/0	-18.5 -18.5	0.16 (4)	10.00			
G-F	0/0	-18.5 -18.5	0.16 (4)	10.00			

TOTAL WEIGHT = 49 lb

(R/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.36")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.36")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CS: TC=0.35/1.00 (B-C:1), BC=0.16/1.00 (G-H:4), WB=0.07/1.00 (D-G:1), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PL) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1666

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.62 (D) (INPUT = 0.90)
JSI METAL = 0.17 (D) (INPUT = 1.00)

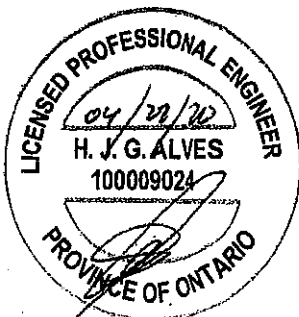


Structural component only
DWG# T-2007074

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408150	T12	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 11:03:01 2020 Page 1
ID:4N4Gt_xHSHnsgnSWZu6izNuP8-59Xq1?cyEg?oiFQsAw?88qPP4ZbxCqUb_u0s8zNCn0

Scale = 1/32

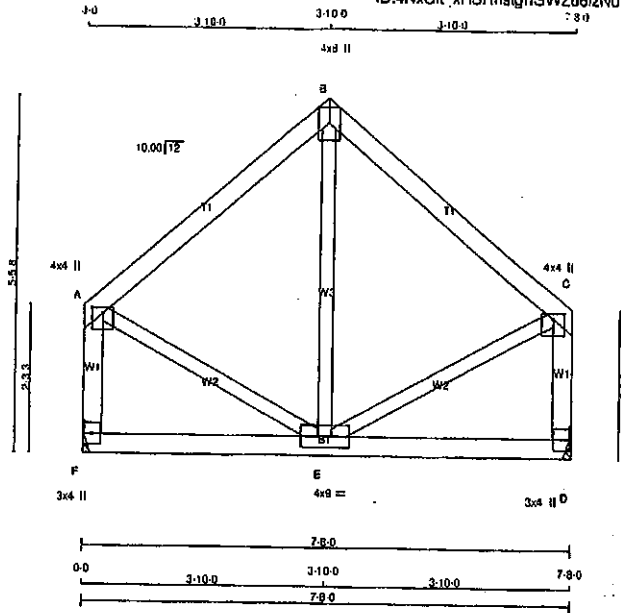

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
A - B	2x4	DRY	No.2		
B - C	2x4	DRY	No.2		
F - A	2x4	DRY	No.2		
D - C	2x4	DRY	No.2		
F - D	2x4	DRY	No.2		

ALL WEBS 2x3 DRY No.2

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.00	2.00
B	TTW+p	MT20	4.0	6.0	Edge	
C	TMVW+p	MT20	4.0	4.0	1.00	2.00
D	BMV1+p	MT20	3.0	4.0		
E	BMVWW-1	MT20	4.0	9.0		
F	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORIZ	DOWN	HORIZ
F	423	0	423	0
D	423	0	423	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F, D. MINIMUM BEARING LENGTH AT JOINT F = 1-8, JOINT D = 1-8.

UNFACTORED REACTIONS

JT	1ST LOASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
	COMBINED					
F	299	196 / 0	0 / 0	0 / 0	103 / 0	0 / 0
D	299	196 / 0	0 / 0	0 / 0	103 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LO)	MAX. FACTORED VERT. LOAD (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LO)
FR-TO		FROM TO					
A-B	-214 / 0	-91.8	-91.8	0.17 (1)	6.25	E-B	-78 / 37
B-C	-214 / 0	-91.8	-91.8	0.17 (1)	6.25	A-E	0 / 184
F-A	-395 / 0	0.0	0.0	0.05 (1)	7.81	E-C	0 / 184
D-C	-395 / 0	0.0	0.0	0.05 (1)	7.81		
F-E	0 / 0	-18.5	-18.5	0.08 (4)	10.00		
E-D	0 / 0	-18.5	-18.5	0.08 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 26.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 888-09, CSA 888-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.26")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.26")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.17/1.00 (B-C:1), BC=0.08/1.00 (D-E:4), WB=0.04/1.00 (A-E:1), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.31 (C) (INPUT = 0.50)
JSI METAL = 0.09 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007075

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408150	T12S	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mike Industries, Inc. Sat Apr 25 11:03:02 2020 Page 1					
ID:4NnGr xHSHnsgnSWZu6izNuP8-ZL5CElda? 7IKP?3keWNg3GbiUw7gecegedZObzNCnN					
Scale = 1:31.0					

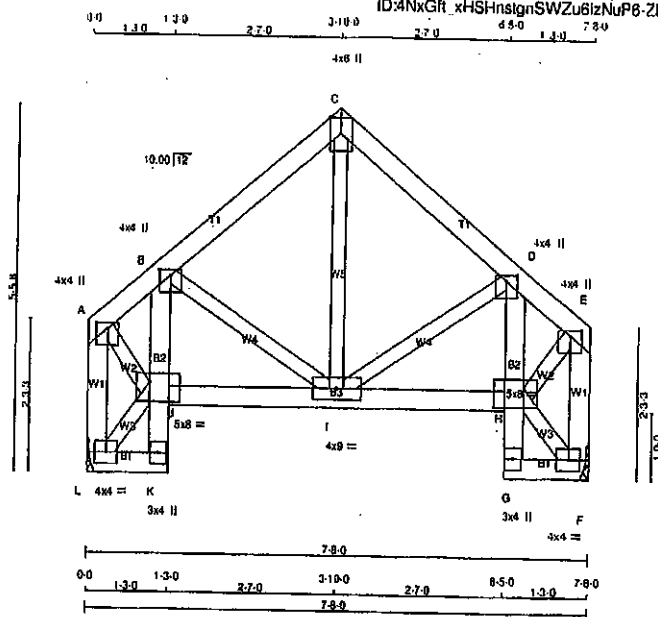

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
L - A	2x4	DRY	No.2
F - E	2x4	DRY	No.2
L - K	2x4	DRY	No.2
K - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
G - D	2x4	DRY	No.2
G - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A, B, D, E					
A	TMVW+p	MT20	4.0	4.0	1.00 2.00
C	TTW+p	MT20	4.0	8.0	Edge
F	BMVW1-t	MT20	4.0	4.0	
G	BMV+p	MT20	3.0	4.0	
H	BVMWW-t	MT20	5.0	8.0	3.50 5.50
I	BVMWW-t	MT20	4.0	9.0	
J	BVMWW-t	MT20	5.0	8.0	3.50 5.50
K	BMV+p	MT20	3.0	4.0	
L	BMVW1-t	MT20	4.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
L	423	0	423	0	0	MECHANICAL	
F	423	0	423	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT L, F. MINIMUM BEARING LENGTH AT JOINT L = 1-8, JOINT F = 1-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	299	198 / 0	0 / 0	0 / 0	0 / 0	103 / 0	0 / 0
F	299	198 / 0	0 / 0	0 / 0	0 / 0	103 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX (PLF)	MEMB.	FORCE (LBS)	MAX (LBS)	MAX (LC)
FR-TO		FROM	TO	FR-TO			
A-B	-282 / 0	-91.8	-91.8 0.08 (1)	I-G	0 / 125	0.03 (1)	
B-C	-274 / 0	-91.8	-91.8 0.07 (1)	I-D	-57 / 0	0.01 (1)	
C-D	-274 / 0	-91.8	-91.8 0.07 (1)	B-I	-57 / 0	0.01 (1)	
D-E	-282 / 0	-91.8	-91.8 0.08 (1)	L-J	-13 / 0	0.00 (1)	
L-A	-404 / 0	0.0	0.0 0.05 (1)	A-J	0 / 317	0.07 (1)	
F-E	-404 / 0	0.0	0.0 0.05 (1)	H-F	-13 / 0	0.00 (1)	
				H-E	0 / 317	0.07 (1)	
L-K	0 / 9	-18.5	-18.5 0.01 (4)				
K-J	0 / 11	0.0	0.0 0.01 (1)				
J-B	-182 / 0	0.0	0.0 0.01 (1)				
J-I	0 / 247	-18.5	-18.5 0.08 (1)				
I-H	0 / 247	-18.5	-18.5 0.08 (1)				
G-H	0 / 11	0.0	0.0 0.01 (1)				
H-D	-182 / 0	0.0	0.0 0.01 (1)				
G-F	0 / 9	-18.5	-18.5 0.01 (4)				

TOTAL WEIGHT = 2 X 43 = 86 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC2010, NBC2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(56% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/360 (0.26")
CALCULATED VERT. DEFL.(LL) = 1/899 (0.00")
ALLOWABLE DEFL.(TL) = 1/360 (0.26")
CALCULATED VERT. DEFL.(TL) = 1/899 (0.01")

CSI: TC=0.07/1.00 (C-D:1), BC=0.08/1.00 (H-I:1), WB=0.07/1.00 (A-J:1), SS=0.09/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MT20	618	354	1867 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.30 (E) (INPUT = 0.90)
JSI METAL = 0.08 (E) (INPUT = 1.00)

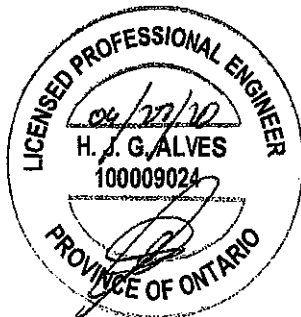

Structural component only
DWG# T-2007076

JOB NAME 408150	TRUSS NAME T15	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:03:03 2020 Page 1	
ID: i7vF?aGOE03cRUj6X1SrkzIWYK-1XibSheCmIFWYzAFIL1cDGpbHuDpP_en2IN7x12NCnM				10101010110	
Scale = 1/16" = 1'-0"					

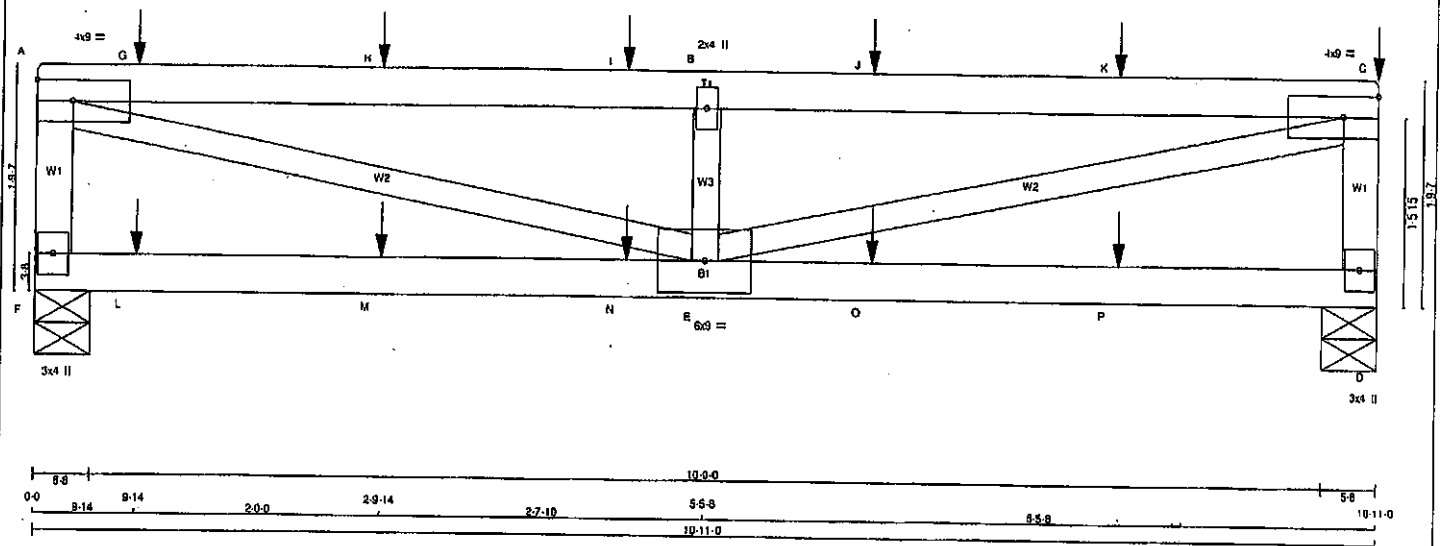

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
F - A	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	4.0	9.0		Edge
B	TMVW-1	MT20	2.0	4.0		
C	TMVW-1	MT20	4.0	9.0		Edge
D	BMVW-1	MT20	3.0	4.0		
E	BMVW-1	MT20	8.0	9.0		
F	BMVW-1	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
F	978	0	978	0	0	5-8
D	1015	0	1015	0	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	690	453 / 0	0 / 0	0 / 0	0 / 0	0 / 0	237 / 0	0 / 0
D	716	479 / 0	0 / 0	0 / 0	0 / 0	0 / 0	237 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.55 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

FR-TO	CHORDS		WEBS	
	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED MEMB. FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)
A-G	-2081 / 0	-91.8	-91.8	0.79 (1)
G-H	-2081 / 0	-91.8	-91.8	0.79 (1)
H-I	-2081 / 0	-91.8	-91.8	0.79 (1)
I-B	-2081 / 0	-91.8	-91.8	0.79 (1)
B-J	-2081 / 0	-91.8	-91.8	0.79 (1)
J-K	-2081 / 0	-91.8	-91.8	0.79 (1)
K-C	-2081 / 0	-91.8	-91.8	0.79 (1)
F-A	-859 / 0	0.0	0.0	0.10 (1)
D-C	-938 / 0	0.0	0.0	0.11 (1)
F-L	0 / 0	-18.5	-18.5	0.22 (4)
L-M	0 / 0	-18.5	-18.5	0.22 (4)
M-N	0 / 0	-18.5	-18.5	0.22 (4)
N-E	0 / 0	-18.5	-18.5	0.22 (4)
E-O	0 / 0	-18.5	-18.5	0.22 (4)
O-P	0 / 0	-18.5	-18.5	0.22 (4)
P-D	0 / 0	-18.5	-18.5	0.22 (4)

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	10-11-0	-123	-123	---	BACK	VERT	TOTAL	---	C1
G	9-14	-90	-90	---	BACK	VERT	TOTAL	---	C1
H	2-9-14	-82	-82	---	BACK	VERT	TOTAL	---	C1
I	4-9-14	-82	-82	---	BACK	VERT	TOTAL	---	C1
J	6-9-14	-82	-82	---	BACK	VERT	TOTAL	---	C1
K	8-9-14	-82	-82	---	BACK	VERT	TOTAL	---	C1
L	9-14	-51	-51	---	BACK	VERT	TOTAL	---	C1
M	2-9-14	-49	-49	---	BACK	VERT	TOTAL	---	C1
N	4-9-14	-49	-49	---	BACK	VERT	TOTAL	---	C1
O	6-9-14	-49	-49	---	BACK	VERT	TOTAL	---	C1
P	8-9-14	-49	-49	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.38")
CALCULATED VERT. DEFL. (LL) = L/999 (0.09")
ALLOWABLE DEFL. (TL) = L/360 (0.38")
CALCULATED VERT. DEFL. (TL) = L/817 (0.18")

CSI: TO=0.79/1.00 (A-B:1), BC=0.22/1.00 (E-F:4), WB=0.53/1.00 (A-E:1), SS=0.39/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSF) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.89 (A) (INPUT = 0.90)
JSI METAL= 0.40 (E) (INPUT = 1.00)

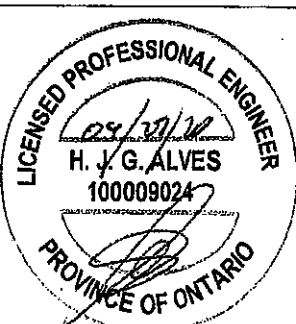

Structural component only
DWG# T-2007077

JOB NAME 408151	TRUSS NAME T20	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	ORWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 11:19:44 2020 Page 1
ID:h2dlgC44wS_E2tzqPs_atzllFw-E6a?Xz51rNUYObeR4VLMmIPQOS:27EXMbZWzNCX

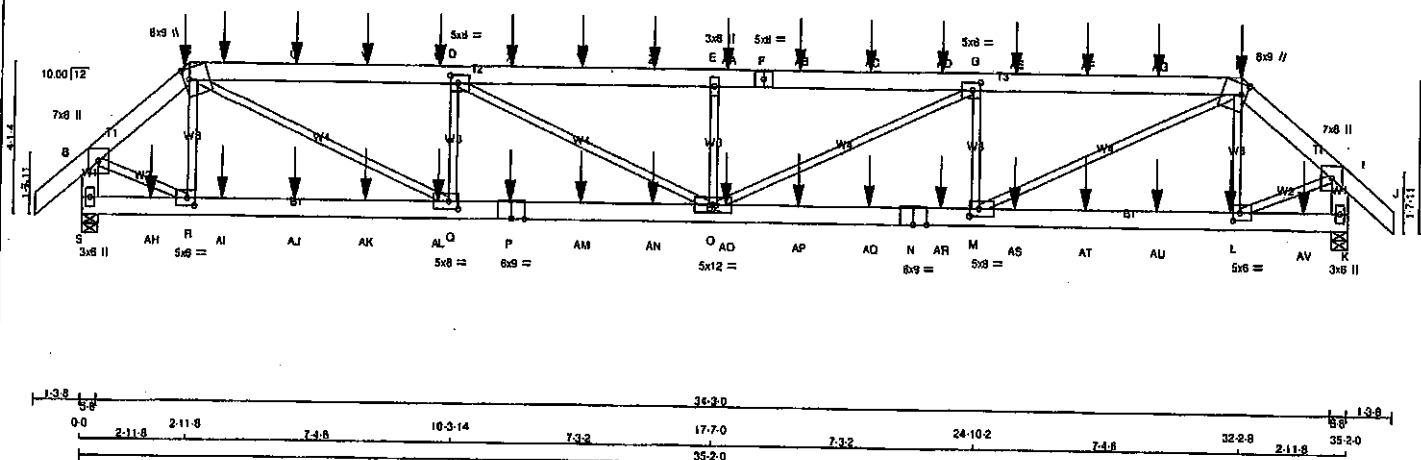

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x6	DRY No.2	SPF
C - F	2x6	DRY No.2	SPF
F - H	2x6	DRY No.2	SPF
H - J	2x6	DRY No.2	SPF
S - B	2x6	DRY No.2	SPF
K - I	2x6	DRY No.2	SPF
S - P	2x6	DRY 1650F 1.5E	SPF
P - N	2x6	DRY 1650F 1.5E	SPF
N - K	2x6	DRY 1650F 1.5E	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	2 12	SIDE(122.0)
C-F	2 12	SIDE(61.0)
F-H	2 12	SIDE(61.0)
H-J	2 12	SIDE(122.0)
S-B	2 12	TOP
K-I	2 12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S-P	2 12	SIDE(0.0)
P-N	2 12	SIDE(0.0)
N-K	2 12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	1 6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	UPLIFT	BRG	BRG	IN-SX
S	3330	0	0	3330	0	0	5-8	5-8	
K	3379	0	0	3379	0	0	5-8	5-8	

UNFACTORED REACTIONS		1ST CASE		MAX/MIN COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
S	2354	1553 / 0	0 / 0	0 / 0	801 / 0
K	2388	1572 / 0	0 / 0	0 / 0	816 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.98 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT.	LC1 MAX	MEMB.	FORCE (LBS)	VERT.	LC1 MAX
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 42	-91.8	-91.8 0.04 (1)	10.00	R-C	-662 / 0	0.08 (1)
B-C	-3359 / 0	-91.8	-91.8 0.05 (1)	6.03	C-Q	0 / 4522	0.56 (1)
C-T	-6608 / 0	-91.8	-91.8 0.38 (1)	4.32	Q-D	-1799 / 0	0.22 (1)
T-U	-6608 / 0	-91.8	-91.8 0.38 (1)	4.32	D-Q	0 / 1375	0.17 (1)
U-V	-6606 / 0	-91.8	-91.8 0.38 (1)	4.32	Q-E	-990 / 0	0.12 (1)
V-W	-6608 / 0	-91.8	-91.8 0.38 (1)	4.32	Q-G	0 / 1368	0.17 (1)
W-D	-6608 / 0	-91.8	-91.8 0.38 (1)	4.32	M-G	-1788 / 0	0.21 (1)
D-X	-7835 / 0	-91.8	-91.8 0.42 (1)	3.98	M-H	0 / 4493	0.58 (1)
X-Y	-7835 / 0	-91.8	-91.8 0.42 (1)	3.98	L-H	-873 / 0	0.08 (1)
Y-Z	-7835 / 0	-91.8	-91.8 0.42 (1)	3.98	B-R	0 / 2729	0.34 (1)
Z-E	-7835 / 0	-91.8	-91.8 0.42 (1)	3.98	L-I	0 / 2784	0.34 (1)
E-AA	-7835 / 0	-91.8	-91.8 0.42 (1)	3.98			
AA-F	-7835 / 0	-91.8	-91.8 0.42 (1)	3.98			
F-AB	-7835 / 0	-91.8	-91.8 0.42 (1)	3.98			
AB-AC	-7835 / 0	-91.8	-91.8 0.42 (1)	3.98			
AC-AD	-7835 / 0	-91.8	-91.8 0.42 (1)	3.98			
AD-G	-7835 / 0	-91.8	-91.8 0.42 (1)	3.98			
G-AE	-6612 / 0	-91.8	-91.8 0.38 (1)	4.32			
AE-AF	-6612 / 0	-91.8	-91.8 0.38 (1)	4.32			
AF-AG	-6612 / 0	-91.8	-91.8 0.38 (1)	4.32			
AG-H	-6612 / 0	-91.8	-91.8 0.38 (1)	4.32			
H-I	-3401 / 0	-91.8	-91.8 0.05 (1)	6.00			
I-J	0 / 42	-91.8	-91.8 0.04 (1)	10.00			
S-B	-3368 / 0	0.0	0.0 0.12 (1)	7.58			
K-I	-3406 / 0	0.0	0.0 0.12 (1)	7.55			
S-AH	0.0	-18.5	-18.5 0.08 (4)	10.00			
AH-R	0.0	-18.5	-18.5 0.08 (4)	10.00			
R-AI	0.2548	-18.5	-18.5 0.16 (1)	10.00			
AI-AJ	0.2548	-18.5	-18.5 0.16 (1)	10.00			
AJ-AK	0.2548	-18.5	-18.5 0.16 (1)	10.00			
AK-AL	0.2548	-18.5	-18.5 0.16 (1)	10.00			
AL-Q	0.2548	-18.5	-18.5 0.16 (1)	10.00			
Q-P	0.6808	-18.5	-18.5 0.32 (1)	10.00			
P-AM	0.6808	-18.5	-18.5 0.32 (1)	10.00			
AM-AN	0.6808	-18.5	-18.5 0.32 (1)	10.00			
AN-O	0.6808	-18.5	-18.5 0.32 (1)	10.00			
O-AP	0.6813	-18.5	-18.5 0.32 (1)	10.00			
AP-AQ	0.6813	-18.5	-18.5 0.32 (1)	10.00			
AQ-N	0.6813	-18.5	-18.5 0.32 (1)	10.00			
N-AR	0.6813	-18.5	-18.5 0.32 (1)	10.00			
AR-M	0.6813	-18.5	-18.5 0.32 (1)	10.00			

TOTAL WEIGHT = 2 X 183 = 366 lbs

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2018
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.20")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.38")

CSI: TC=0.42/1.00 (D-E:1), BC=0.32/1.00 (Q-Q:1),
WB=0.58/1.00 (C-Q:1), SS=0.22/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HELLS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1659

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.62 IN (INPUT = 0.90)
JSI METAL= 0.52 IP (INPUT = 1.00)

CONTINUED ON PAGE 2



Structural component only
DWG# T-2007081 1/2

JOB NAME 408151	TRUSS NAME T20	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310.3 Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:19:44 2020 Page 2
ID:h2df1qC44wS E2zqPs atzIRw-E6e7Xz51rNUYOberR4VLHMmIPQoOSi27EXMbZWzNCX

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+tp	MT20	7.0	8.0			
C	TTWW+m	MT20	8.0	9.0	3.50	1.75	
D	TMWW-l	MT20	5.0	6.0	2.50	2.50	
E	TMW+ww	MT20	3.0	6.0			
F	TS-l	MT20	5.0	6.0			
G	TMWW-l	MT20	5.0	6.0	2.50	2.50	
H	TTWW+m	MT20	8.0	9.0	3.50	1.75	
I	TMVW+tp	MT20	7.0	8.0			
K	BMV1+tp	MT20	3.0	6.0			
L	BMWW-l	MT20	5.0	6.0	2.50	2.25	
M	BMWW-l	MT20	5.0	6.0	2.50	3.00	
N	BS-l	MT20	6.0	9.0			
O	BMWWW-l	MT20	5.0	12.0			
P	BS-l	MT20	6.0	9.0			
Q	BMWW-l	MT20	5.0	8.0	2.50	3.00	
R	BMWW-l	MT20	5.0	6.0	2.50	2.25	
S	BMV1+tp	MT20	3.0	6.0			

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MAX. UNBRAC LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO		FROM TO					
M-AS	0 / 2579	-18.5	-18.5 0.16 (1)	10.00			
AS-AT	0 / 2579	-18.5	-18.5 0.16 (1)	10.00			
AT-AU	0 / 2579	-18.5	-18.5 0.16 (1)	10.00			
AU-L	0 / 2579	-18.5	-18.5 0.16 (1)	10.00			
L-AV	0 / 0	-18.5	-18.5 0.08 (4)	10.00			
AV-K	0 / 0	-18.5	-18.5 0.08 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	2-11-8	-38	-42	---	FRONT	VERT	DEAD	---	C1
H	32-2-8	-38	-42	---	FRONT	VERT	SNOW	---	C1
H	32-2-8	-116	-119	---	FRONT	VERT	DEAD	---	C1
H	32-2-8	-191	-191	---	FRONT	VERT	TOTAL	---	C1
L	31-11-4	-28	-28	---	FRONT	VERT	SNOW	---	C1
P	11-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
T	3-11-4	-111	-111	---	FRONT	VERT	TOTAL	---	C1
U	5-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	17-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	19-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	21-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	23-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	25-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	27-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AG	29-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AH	1-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AI	3-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AJ	5-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AK	7-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AL	9-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AM	13-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AN	15-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AO	17-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AP	19-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AQ	21-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AR	23-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AS	25-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AT	27-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AU	29-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AV	33-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2007081 3/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408151	T20Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 ANtek Industries, Inc. Sat Apr 25 11:19:45 2020 Page 1
ID:h2dflgC44wS E2t2qPs_atzllRw-iJCOLmko9VL9YAq n0aqaJuZ04EB5KGTB585yzNCX

13.8 0.0 2.11.8 2.11.8 7.4.6 10.3.14 5.0.14 15.4.12 17.3.12 17.7.0 24.10.2 32.2.8 35.2.0 38.5.8
Scale = 1:57.3

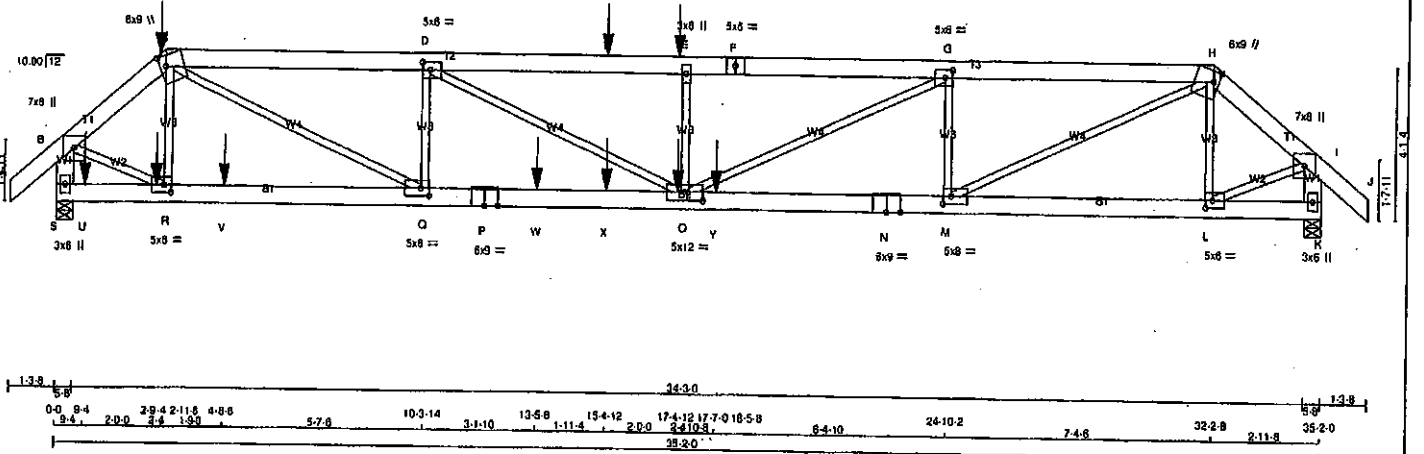

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x8 DRY	No.2	SPF		
C - F	2x8 DRY	No.2	SPF		
F - H	2x8 DRY	No.2	SPF		
H - J	2x8 DRY	No.2	SPF		
J - B	2x8 DRY	No.2	SPF		
K - I	2x8 DRY	No.2	SPF		
S - P	2x8 DRY	1650F 1.5E	SPF		
P - N	2x8 DRY	1650F 1.5E	SPF		
N - K	2x8 DRY	1650F 1.5E	SPF		

ALL WEBS EXCEPT 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A - C 2	12	SIDE (122.0)
C - F 2	12	SIDE (183.1)
F - H 2	12	TOP
H - J 2	12	TOP
J - B 2	12	TOP
K - I 2	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
S - P 2	12	SIDE (183.1)
P - N 2	12	SIDE (183.1)
N - K 2	12	TOP
WEBS: (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT		RECORD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX	BRG
S	4991	0	4991	0	0	5-8	5-8	5-8	5-8
K	3694	0	3694	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS
S	3528	2923 / 0
K	2608	1737 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.20 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LG)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LG)	
FR-TO				FR-TO			
A-B	0 / 42	-91.8	-91.8 0.04 (1)	10.00	R-C	-253 / 44	0.03 (1)
B-C	-5342 / 0	-91.8	-91.8 0.07 (1)	5.02	C-Q	0 / 6569	0.81 (1)
C-D	-9971 / 0	-91.8	-91.8 0.39 (1)	3.64	Q-D	-1958 / 0	0.23 (1)
D-T	-12379 / 0	-91.8	-91.8 0.52 (1)	3.20	D-O	0 / 2594	0.39 (1)
T-E	-12379 / 0	-91.8	-91.8 0.52 (1)	3.20	O-E	-782 / 0	0.09 (1)
E-F	-12379 / 0	-91.8	-91.8 0.49 (1)	3.23	O-G	0 / 4229	0.52 (1)
F-G	-12379 / 0	-91.8	-91.8 0.49 (1)	3.23	G-H	-2619 / 0	0.31 (1)
G-H	-8589 / 0	-91.8	-91.8 0.33 (1)	3.83	H-I	0 / 5416	0.79 (1)
H-I	-3750 / 0	-91.8	-91.8 0.06 (1)	5.79	I-J	-864 / 0	0.10 (1)
I-J	0 / 42	-91.8	-91.8 0.04 (1)	10.00	J-K	0 / 4341	0.54 (1)
S-B	-5197 / 0	0.0	0.0 0.19 (1)	6.41	L-I	0 / 3047	0.38 (1)
K-I	-3727 / 0	0.0	0.0 0.13 (1)	7.30			
S-U	0 / 0	-18.5	-18.5 0.20 (1)	10.00			
U-R	0 / 0	-18.5	-18.5 0.20 (1)	10.00			
R-V	0 / 4073	-18.5	-18.5 0.36 (1)	10.00			
V-Q	0 / 4073	-18.5	-18.5 0.36 (1)	10.00			
Q-P	0 / 9971	-18.5	-18.5 0.73 (1)	10.00			
P-W	0 / 9971	-18.5	-18.5 0.73 (1)	10.00			
W-X	0 / 9971	-18.5	-18.5 0.73 (1)	10.00			
X-O	0 / 9971	-18.5	-18.5 0.73 (1)	10.00			
O-Y	0 / 8900	-18.5	-18.5 0.58 (1)	10.00			
Y-N	0 / 8900	-18.5	-18.5 0.58 (1)	10.00			
N-M	0 / 8900	-18.5	-18.5 0.58 (1)	10.00			
M-L	0 / 2839	-18.5	-18.5 0.16 (1)	10.00			
L-K	0 / 0	-18.5	-18.5 0.05 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	2-11-8	-38	-42	---	FRONT	VERT	DEAD	---	C1
C	2-11-8	-117	-117	---	BACK	VERT	TOTAL	---	C1
E	2-11-8	-191	-191	---	FRONT	VERT	SNOW	---	C1
O	17-4-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
T	17-4-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
U	2-9-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
T	15-4-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
U	9-4	-29	-29	---	BACK	VERT	TOTAL	---	C1
V	4-8-8	-1066	-1066	---	BACK	VERT	TOTAL	---	C1
W	13-5-8	-1066	-1066	---	BACK	VERT	TOTAL	---	C1
X	15-4-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
Y	18-5-8	-1738	-1738	---	BACK	VERT	TOTAL	---	C1

TOTAL WEIGHT = 2 X 183 = 365 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.33")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/685 (0.82")

CSI: TC=0.521.00 (D-E:1), BC=0.731.00 (O-Q:1), WB=0.811.00 (C-Q:1), SI=0.571.00 (M-O:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1997 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (D) (INPUT = 0.90)
JSI METAL = 0.84 (P) (INPUT = 1.00)

CONTINUED ON PAGE 2



Structural component only
DWG# T-2007082 1/2

JOB NAME 408151	TRUSS NAME T20Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington


Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 11:19:45 2020 Page 2
ID:h2dlqC44wS E2lzoPs atzIRw-UCQUmko9VL9YAq n0agaJuZc4EB5KGTB585vzNCX

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	7.0	8.0		
C	TTWW+m	MT20	8.0	9.0	3.50	1.75
D	TMWW-i	MT20	5.0	8.0	2.50	2.50
E	TMW+w	MT20	3.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMWW-i	MT20	5.0	8.0	2.50	2.50
H	TTWW+m	MT20	8.0	9.0	3.50	1.75
I	TMVW+p	MT20	7.0	8.0		
K	BMV1+p	MT20	3.0	6.0		
L	BMWW-t	MT20	5.0	6.0	2.50	2.25
M	BMWW-i	MT20	5.0	8.0	2.50	2.75
N	BS-i	MT20	8.0	9.0		
O	BMWWW-i	MT20	5.0	12.0	2.75	6.00
P	BS-i	MT20	8.0	9.0		
Q	BMWW-i	MT20	5.0	8.0	2.50	2.75
R	BMWW-i	MT20	5.0	6.0	2.50	2.25
S	BMV1+p	MT20	3.0	6.0		

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

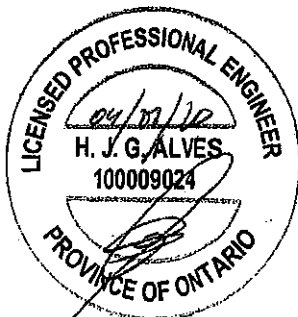

Structural component only
DWG# T-2007082 7/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408151	T21	2	1	TRUSS DESC.		


Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 11:19:46 2020 Page 1

ID:h2dfqC44wS_E2tqPs_atzIRw-AVImyImMZTdCnI0YUXpMnr1ECRIweZQhrrdOzNCXh

20.3.0 5.3.15 25.6.15 5.3.3 31.0.2 4.1.14 35.2.0 35.2.0 35.2.0

Scale = 1:57.3

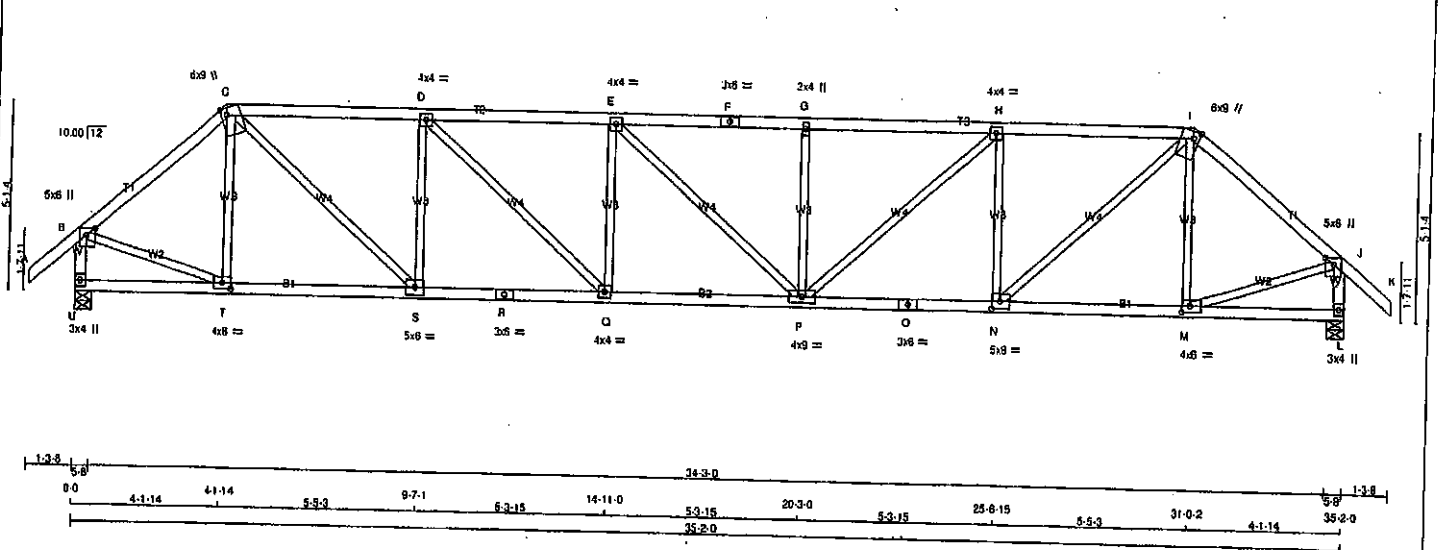

0.0 4.1-14 4.1-14 5.3.3 9.7.1 5.3.15 14.11.0 5.3.15 20.3.0 5.3.15 25.6.15 5.3.3 31.0.2 4.1.14 35.2.0

LUMBER		CHORDS		SIZE		DRY		LUMBER		DESCR.		SPF		ALL WEBS		EXCEPT		DRY: SEASONED LUMBER.		DESIGN CRITERIA		TOTAL WEIGHT = 2 X 147 = 293 lb		(M)	
N. L. G. A. RULES																									
A - C	2x4	DRY	No.2																						
C - F	2x4	DRY	No.2																						
F - I	2x4	DRY	No.2																						
I - K	2x4	DRY	No.2																						
U - B	2x4	DRY	No.2																						
L - J	2x4	DRY	No.2																						
U - R	2x4	DRY	No.2																						
R - O	2x4	DRY	No.2																						
O - L	2x4	DRY	No.2																						
ALL WEBS	2x3	DRY	No.2																						
EXCEPT																									

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.20 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

BMWW-t

MT20

5.0

8.0

2.50

2.75

BS-t

MT20

3.0

8.0

BMWW-t

MT20

4.0

9.0

BMWW-t

MT20

4.0

4.0

BS-t

MT20

3.0

8.0

BMWW-t

MT20

5.0

8.0

BMWW-t

MT20

4.0

8.0

BMV-t

MT20

3.0

4.0

0.0

INDICATES REFERENCE CORNER OF PLATE

TOUCHES EDGE OF CHORD.

0.141

-1980.0

-2871.0

-3506.0

-3505.0

-3505.0

-2871.0

-1980.0

0.141

-2037.0

-2037.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

Structural component only
DWG# T-2007083

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019

- PART 9 OF OBC 2012 (2019 AMENDMENT)

- CSA 088-09, CSA 088-14

- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')

CALCULATED VERT. DEFL.(LL) = L/999 (0.20')

ALLOWABLE DEFL.(TL) = L/360 (1.17')

CALCULATED VERT. DEFL.(TL) = L/999 (0.39')

CSI: TC=0.66/1.00 (G-H:1), BC=0.62/1.00 (P-Q:1), WB=0.43/1.00 (D-S:1), SS=0.23/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 818 354 1687 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (S) (INPUT = 0.90)

JSI METAL= 0.80 (C) (INPUT = 1.00)

JOB NAME 408151	TRUSS NAME T22	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:19:47 2020 Page 1	
ID:h2dlfgC44wS_E2lqPs_atzllRw-ehJ89?n_Km3PrKD6C22v7OAzcpWf3vZwVaFArzNCXq				Scale = 1:57.4	

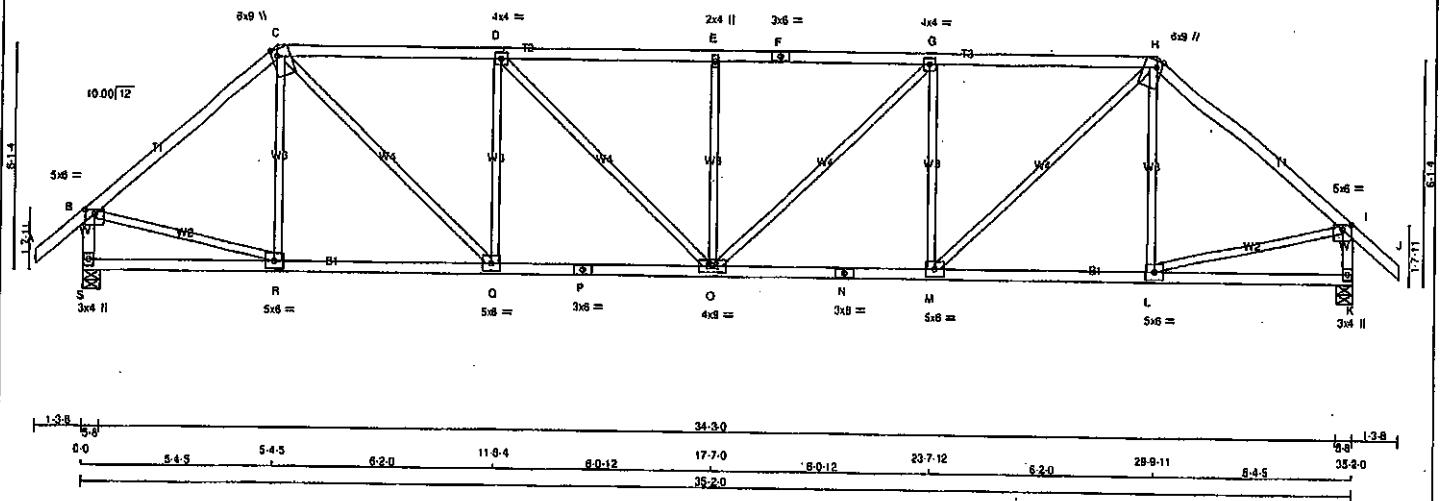

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4 DRY	No.2	SPF
C - F	2x4 DRY	No.2	SPF
F - H	2x4 DRY	No.2	SPF
H - J	2x4 DRY	No.2	SPF
S - B	2x4 DRY	No.2	SPF
K - I	2x4 DRY	No.2	SPF
S - P	2x4 DRY	No.2	SPF
P - N	2x4 DRY	No.2	SPF
N - K	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	6.0	1.50 3.00
C	TTWW-m	MT20	6.0	9.0	Edge 1.75
D	TMVW-t	MT20	4.0	4.0	
E	TMVW-w	MT20	2.0	4.0	
F	TS-t	MT20	3.0	6.0	
G	TMVW-t	MT20	4.0	4.0	
H	TTWW-m	MT20	6.0	9.0	Edge 1.75
I	TMVW-p	MT20	5.0	6.0	1.50 3.00
K	BMV1-p	MT20	3.0	4.0	
L, M, O, R					
L	BMVW-t	MT20	5.0	6.0	
N	BS-t	MT20	3.0	6.0	
O	BMVWW-t	MT20	4.0	9.0	
P	BS-t	MT20	3.0	6.0	
S	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
S	2068	0	2068	0	5-8
K	2068	0	2068	0	5-8

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
K	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.28 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (FT)
FR-TO			
A-B	0 / 41	-91.8 -91.8 0.13 (1)	10.00
B-C	-2004 / 0	-91.8 -91.8 0.84 (1)	4.11
C-D	-2653 / 0	-91.8 -91.8 0.74 (1)	3.50
D-E	-2978 / 0	-91.8 -91.8 0.78 (1)	3.28
E-F	-2978 / 0	-91.8 -91.8 0.78 (1)	3.28
F-G	-2978 / 0	-91.8 -91.8 0.78 (1)	3.28
G-H	-2653 / 0	-91.8 -91.8 0.74 (1)	3.50
H-I	-2004 / 0	-91.8 -91.8 0.84 (1)	4.11
I-J	0 / 41	-91.8 -91.8 0.13 (1)	10.00
S-B	-2026 / 0	0.0 0.0 0.22 (1)	5.94
K-I	-2026 / 0	0.0 0.0 0.22 (1)	5.94
S-R	0 / 0	-18.5 -18.5 0.14 (4)	10.00
R-Q	0 / 1532	-18.5 -18.5 0.33 (1)	10.00
Q-P	0 / 2653	-18.5 -18.5 0.49 (1)	10.00
P-O	0 / 2653	-18.5 -18.5 0.49 (1)	10.00
O-N	0 / 2653	-18.5 -18.5 0.49 (1)	10.00
N-M	0 / 2653	-18.5 -18.5 0.49 (1)	10.00
M-L	0 / 1532	-18.5 -18.5 0.33 (1)	10.00
L-K	0 / 0	-18.5 -18.5 0.14 (4)	10.00

TOTAL WEIGHT = 2 X 148 = 296 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.16")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.28")

CSI: TC=0.78/1.00 (D-E:1), BC=0.49/1.00 (O-Q:1),
WB=0.55/1.00 (G-M:1), SS=0.27/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 -618 354 1657 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (B) (INPUT = 0.90)
JSI METAL = 0.85 (N) (INPUT = 1.00)



Structural component only
DWG# T-2007084

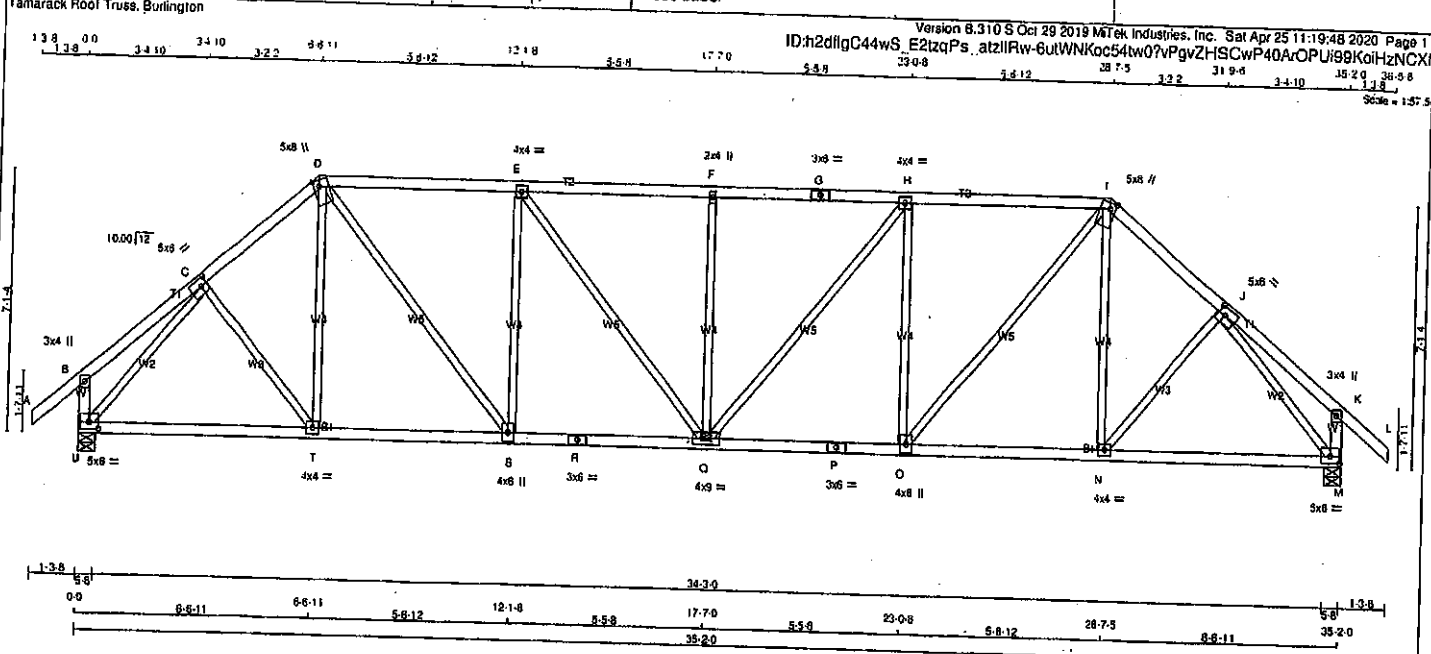

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - G	2x4	DRY No.2	SPF
G - I	2x4	DRY No.2	SPF
I - L	2x4	DRY No.2	SPF
U - B	2x4	DRY No.2	SPF
M - K	2x4	DRY No.2	SPF
U - R	2x4	DRY No.2	SPF
P - P	2x4	DRY No.2	SPF
R - M	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-i	MT20	5.0	6.0	2.50	2.25
D	TTWW+m	MT20	5.0	8.0	2.00	1.75
E	TMWW-i	MT20	4.0	4.0		
F	TMWW+w	MT20	2.0	4.0		
G	TS-i	MT20	3.0	6.0		
H	TMWW-i	MT20	4.0	4.0		
I	TTWW+m	MT20	5.0	8.0	2.00	1.75
J	TMWW-i	MT20	5.0	6.0	2.50	2.25
K	TMV+p	MT20	3.0	4.0		
M	BMVW-i	MT20	5.0	6.0	2.25	3.00
N	BMVW-i	MT20	4.0	4.0		
O	BMVW-i	MT20	4.0	6.0		
P	BS-i	MT20	3.0	6.0		
Q	BMVWW-i	MT20	4.0	9.0		
R	BS-i	MT20	3.0	8.0		
S	BMVW-i	MT20	4.0	8.0		
T	BMVW-i	MT20	4.0	4.0		
U	BMVW-i	MT20	5.0	6.0	2.25	3.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	RECORD
JT VERT 2068	DOWN 2068	UPLIFT 0	BRG IN-SX 5-8
U 2068	DOWN 2068	UPLIFT 0	BRG IN-SX 5-8
M 2068	DOWN 2068	UPLIFT 0	BRG IN-SX 5-8

UNFACTORED REACTIONS

1ST LOASE	MAXIMUM COMPONENT REACTIONS	DEAD	SOIL
JT COMBINED SNOW	LIVE 0/0	PERM.LIVE 0/0	DEAD 488/0
U 1458	LIVE 0/0	PERM.LIVE 0/0	DEAD 488/0
M 1458	LIVE 0/0	PERM.LIVE 0/0	DEAD 488/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0/41	-91.8 -91.8 0.13 (1)	10.00	C-T	0/156	0.04 (1)	
B-C	0/19	-91.8 -91.8 0.14 (1)	10.00	T-D	0/76	0.03 (4)	
C-D	-2023/0	-91.8 -91.8 0.20 (1)	4.59	D-S	0/1220	0.27 (1)	
D-E	-2308/0	-91.8 -91.8 0.55 (1)	3.94	S-E	-850/0	0.74 (1)	
E-F	-2534/0	-91.8 -91.8 0.57 (1)	3.77	E-Q	0/361	0.08 (1)	
F-G	-2534/0	-91.8 -91.8 0.57 (1)	3.77	Q-F	-461/0	0.40 (1)	
G-H	-2534/0	-91.8 -91.8 0.57 (1)	3.77	H-Q	0/361	0.08 (1)	
H-I	-2308/0	-91.8 -91.8 0.20 (1)	4.59	O-I	0/1220	0.27 (1)	
I-J	-2023/0	-91.8 -91.8 0.55 (1)	3.94	O-H	-850/0	0.74 (1)	
J-K	0/19	-91.8 -91.8 0.14 (1)	10.00	N-I	0/76	0.03 (4)	
K-L	0/41	-91.8 -91.8 0.13 (1)	10.00	N-J	0/156	0.04 (1)	
U-B	-246/0	0.0 0.0 0.03 (1)	7.81	U-C	-2277/0	0.98 (1)	
M-K	-246/0	0.0 0.0 0.03 (1)	7.81	J-M	-2277/0	0.98 (1)	
U-T	0/1433	-18.5 -18.5 0.33 (1)	10.00				
T-S	0/1535	-18.5 -18.5 0.35 (1)	10.00				
S-R	0/2308	-18.5 -18.5 0.42 (1)	10.00				
R-Q	0/2308	-18.5 -18.5 0.42 (1)	10.00				
Q-P	0/2308	-18.5 -18.5 0.42 (1)	10.00				
P-O	0/2308	-18.5 -18.5 0.42 (1)	10.00				
O-N	0/1535	-18.5 -18.5 0.35 (1)	10.00				
N-M	0/1433	-18.5 -18.5 0.33 (1)	10.00				

TOTAL WEIGHT = 2 X 162 = 323 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCG 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.13')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.23')

CSI: TC=0.571/0 (E-F:1), BC=0.421/0 (O-Q:1),
WB=0.98/1.00 (J-M:1), SSI=0.24/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP=0.88 (I) (INPUT = 0.80)
JSI METAL=0.72 (P) (INPUT = 1.00)

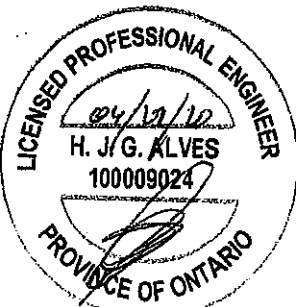

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408151	T24	2	1	GREEN PARK HOMES	

Tamrack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:19:48 2020 Page 1
ID:h2dflgC44wS E2tqPs_atzIRw-a4RuagpEsO?ne9UbDd4W_QT XEPW57sssNp3MEjzNCXe

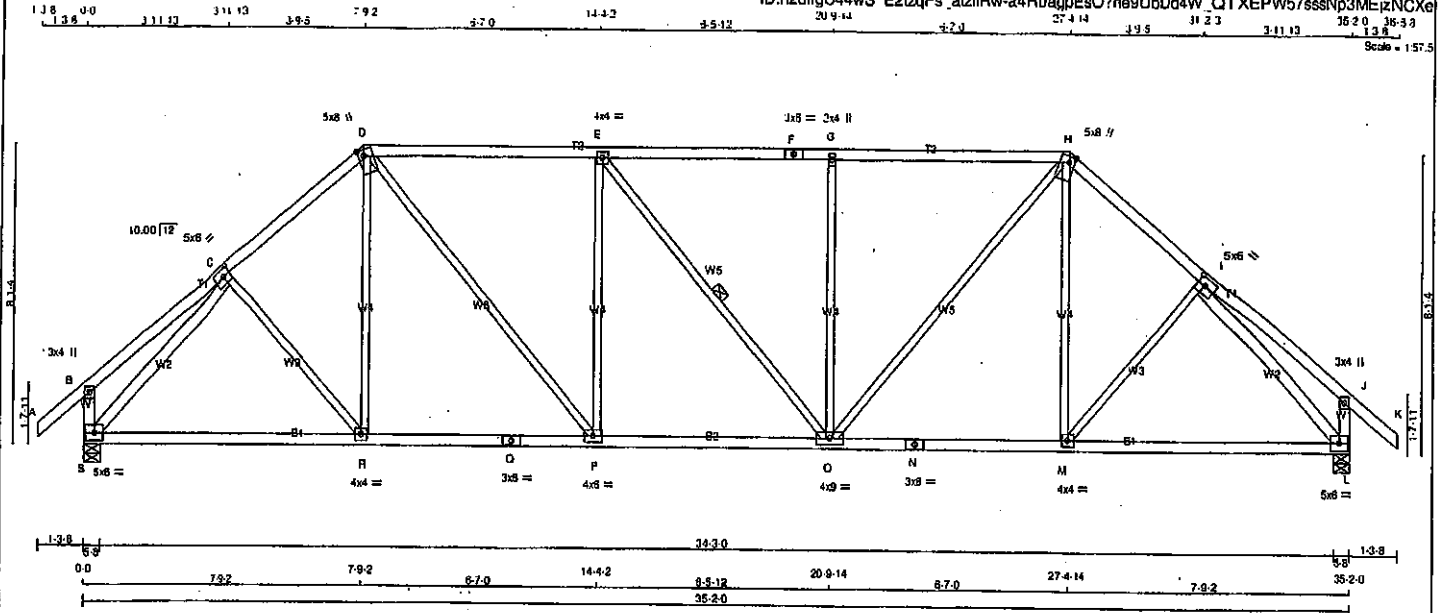

TOTAL WEIGHT = 2 X 183 = 326 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (Labels in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-t	MT20	5.0	6.0	2.50	2.50
D	TTVW+m	MT20	5.0	8.0	2.00	1.75
E	TMVW-t	MT20	4.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMV+w	MT20	2.0	4.0		
H	TTVW+m	MT20	5.0	8.0	2.00	1.75
I	TMVW-t	MT20	5.0	6.0	2.50	2.50
J	TMV+p	MT20	3.0	4.0		
L	BMVW-t	MT20	5.0	6.0		
M	BMVW-t	MT20	4.0	4.0		
N	BS-t	MT20	3.0	6.0		
O	BMVW-t	MT20	4.0	6.0		
P	BMVW-t	MT20	4.0	6.0		
Q	BS-t	MT20	3.0	6.0		
R	BMVW-t	MT20	4.0	4.0		
S	BMVW-t	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
S	2066	0	2066	0	5-8	5-8	5-8
L	2066	0	2066	0	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1458	971.0	0.0	0.0	0.0	488.0	0.0
L	1458	971.0	0.0	0.0	0.0	488.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.81 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. UNBRACED LENGTH (FT)
FR-TO		FROM TO		FR-TO			
A-B	0.141	-91.8 -91.8	0.13 (1)	10.00	C-R	0.164	0.02 (4)
B-C	0.126	-91.8 -91.8	0.21 (1)	10.00	R-D	0.126	0.04 (4)
C-D	-2008.0	-91.8 -91.8	0.29 (1)	4.50	D-P	0.998	0.22 (1)
D-E	-2163.0	-91.8 -91.8	0.73 (1)	3.81	P-E	-650.0	0.82 (1)
E-F	-2162.0	-91.8 -91.8	0.73 (1)	3.81	E-O	-2.0	0.00 (1)
F-G	-2162.0	-91.8 -91.8	0.73 (1)	3.81	O-G	-649.0	0.82 (1)
G-H	-2162.0	-91.8 -91.8	0.73 (1)	3.82	O-H	0.996	0.22 (1)
H-I	-2008.0	-91.8 -91.8	0.29 (1)	4.50	M-H	0.126	0.04 (4)
I-J	0.128	-91.8 -91.8	0.21 (1)	10.00	M-I	0.164	0.02 (4)
J-K	0.141	-91.8 -91.8	0.13 (1)	10.00	S-C	-2291.0	0.97 (1)
S-B	-264.0	0.0 0.0	0.03 (1)	7.81	I-L	-2291.0	0.97 (1)
L-J	-264.0	0.0 0.0	0.03 (1)	7.81			
S-R	0.1487	-18.5 -18.5	0.38 (1)	10.00			
R-Q	0.1519	-18.5 -18.5	0.39 (1)	10.00			
Q-P	0.1519	-18.5 -18.5	0.39 (1)	10.00			
P-O	0.2163	-18.5 -18.5	0.42 (1)	10.00			
O-N	0.1519	-18.5 -18.5	0.39 (1)	10.00			
N-M	0.1519	-18.5 -18.5	0.39 (1)	10.00			
M-L	0.1487	-18.5 -18.5	0.38 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.21")

CSI: TC=0.73/1.00 (D-E:1), BC=0.42/1.00 (O-P:1),
WB=0.97/1.00 (I-L:1), SSI=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(OR)	SHEAR (PSI)	SECTION (PL)
MT20	618	354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (I) (INPUT = 0.80)
JSI METAL = 0.56 (I) (INPUT = 1.00)




Structural component only
DWG# T-2007086

DRY: SEASONED LUMBER.


BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U. L.

JSI GRIP = 0.89 (B) (INPUT = 0.90)
JSI METAL = 0.50 (O) (INPUT = 1.00)



JOB NAME 408151	TRUSS NAME T26	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Farnack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 11:19:51 2020 Page 1
ID: 2d1qC44wS_E2tqPs_at3Rw-WSZ?MqUO?FV(TG_L27_3rYteDDbsO9r7YTJczNCXc

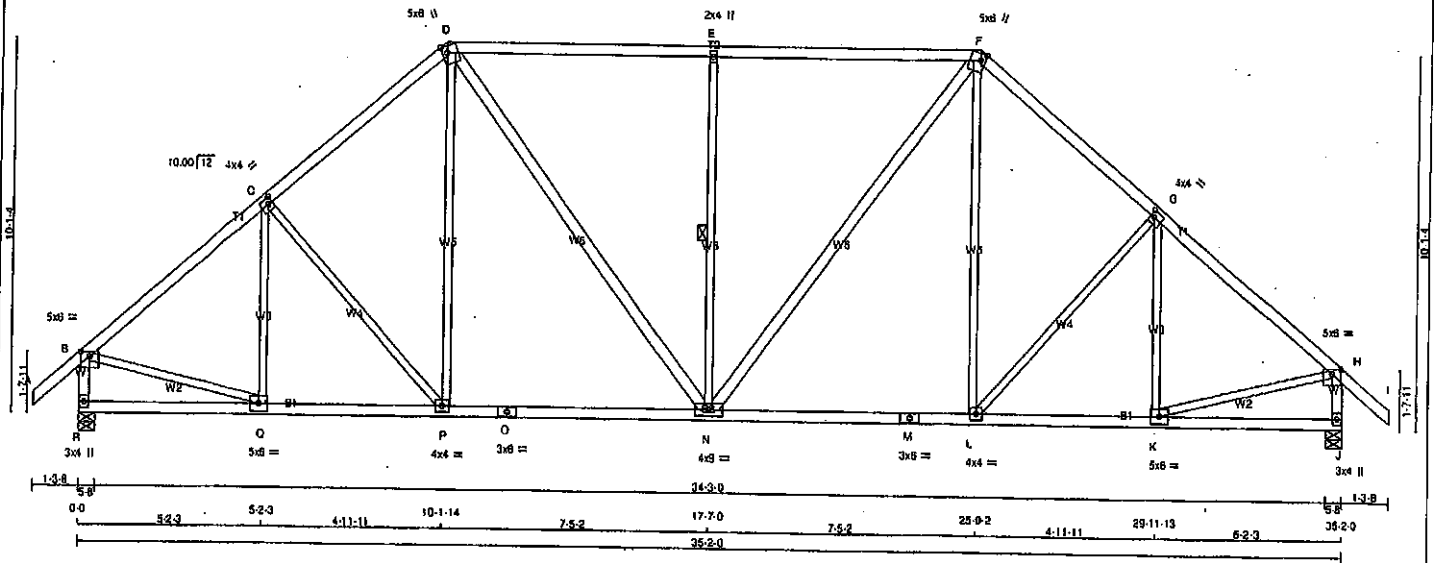

LUMBER				DESIGN CRITERIA			
N. L. G. A. RULES				SPECIFIED LOADS:			
CHORDS	SIZE	DRY	LUMBER	TOP CH. LL =	25.0	PSF	
A - D	2x4	DRY	No.2	DL =	6.0	PSF	
D - F	2x4	DRY	No.2	LL =	0.0	PSF	
F - B	2x4	DRY	No.2	DL =	7.4	PSF	
J - H	2x4	DRY	No.2	TOTAL LOAD =	39.0	PSF	
R - O	2x4	DRY	No.2				
O - M	2x4	DRY	No.2				
M - J	2x4	DRY	No.2				
ALL WEBS 2x3 DRY No.2				SPACING = 24.0 IN. C/C			
EXCEPT				LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12			
D - N	2x4	DRY	No.2	THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015			
N - F	2x4	DRY	No.2	THIS DESIGN COMPLIES WITH:			
DRY: SEASONED LUMBER.				- PART 9 OF NBC 2010, NBC 2012, ABC 2019			
				- PART 9 OF NBC 2012 (2019 AMENDMENT)			
				- CSA 086-09, CSA 086-14			
				- TPIC 2011, TPIC 2014			
				(56 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD			
				ALLOWABLE DEFL.(LL) = L/360 (1.17")			
				CALCULATED VERT. DEFL.(LL) = L/999 (0.08")			
				ALLOWABLE DEFL.(TL) = L/360 (1.17")			
				CALCULATED VERT. DEFL.(TL) = L/999 (0.17")			
				CSI: TC=0.74/1.00 (D-E:1), BC=0.35/1.00 (L-N:1), WB=0.58/1.00 (E-N:1), SS=0.33/1.00 (D-E:1)			
				DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10			
				COMP=1.10 SHEAR=1.10 TENS=1.10			
				COMPANION LIVE LOAD FACTOR = 1.00			
				TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.			
				NAIL VALUES			
				PLATE GRIP(DRY) SHEAR SECTION			
				(PSI) (PLI) (PLI)			
				MAX MIN MAX MIN MAX MIN			
				MT20 618 354 1687 788 1987 1656			
				PLATE PLACEMENT TOL. = 0.250 inches			
				PLATE ROTATION TOL. = 5.0 Deg.			
				JSI GRIP= 0.89 (S) (INPUT = 0.90)			
				JSI METAL= 0.46 (M) (INPUT = 1.00)			

PLATES (table is in inches)				BEARINGS			
JT TYPE	PLATES	W	LEN Y X	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
B TMWV-p	MT20	5.0	8.0	1.50	3.00		
C TMWW-l	MT20	4.0	4.0	2.00	1.25		
D TTWW+m	MT20	5.0	6.0	2.25	1.50		
E TMW-w	MT20	2.0	4.0				
F TTWW+m	MT20	5.0	8.0	2.25	1.50		
G TMWW-l	MT20	4.0	4.0	2.00	1.25		
H TMWV-p	MT20	5.0	6.0	1.50	3.00		
J BMV1-p	MT20	3.0	4.0				
K BMWV-l	MT20	5.0	6.0				
L BMWV-l	MT20	4.0	4.0				
M BS-l	MT20	3.0	6.0				
N BMWW-l	MT20	4.0	9.0				
O BS-l	MT20	3.0	6.0				
P BMWV-l	MT20	4.0	4.0				
Q BMWV-l	MT20	5.0	6.0				
R BMV1-p	MT20	3.0	4.0				

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0/41	-91.8	-91.8 0.13 (1)	10.00	C-C	-302/0	0.17 (1)
B-C	-2021/0	-91.8	-91.8 0.39 (1)	4.41	C-P	-217/0	0.25 (1)
C-D	-1908/0	-91.8	-91.8 0.37 (1)	4.62	P-D	0/278	0.06 (1)
D-E	-1809/0	-91.8	-91.8 0.74 (1)	3.98	D-N	0/615	0.10 (1)
E-F	-1809/0	-91.8	-91.8 0.74 (1)	3.98	N-E	-838/0	0.58 (1)
F-G	-1808/0	-91.8	-91.8 0.37 (1)	4.62	N-F	0/615	0.10 (1)
G-H	-2021/0	-91.8	-91.8 0.39 (1)	4.41	L-F	0/278	0.06 (1)
H-I	0/41	-91.8	-91.8 0.13 (1)	10.00	L-G	-217/0	0.25 (1)
I-J	-2024/0	0.0	0.0 0.22 (1)	5.94	K-G	-302/0	0.17 (1)
J-H	-2024/0	0.0	0.0 0.22 (1)	5.94	B-Q	0/1629	0.37 (1)
R-Q	0/0	-18.5	-18.5 0.10 (4)	10.00	K-H	0/1629	0.37 (1)
Q-P	0/1580	-18.5	-18.5 0.34 (1)	10.00			
P-O	0/1437	-18.5	-18.5 0.35 (1)	10.00			
O-N	0/1437	-18.5	-18.5 0.35 (1)	10.00			
N-M	0/1437	-18.5	-18.5 0.35 (1)	10.00			
M-L	0/1437	-18.5	-18.5 0.35 (1)	10.00			
L-K	0/1580	-18.5	-18.5 0.34 (1)	10.00			
K-J	0/0	-18.5	-18.5 0.10 (4)	10.00			

Structural component only
DWG# T-2007088

LOADING

TOTAL LOAD CASES: (4)

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.98 FT.


MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408151	T27	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

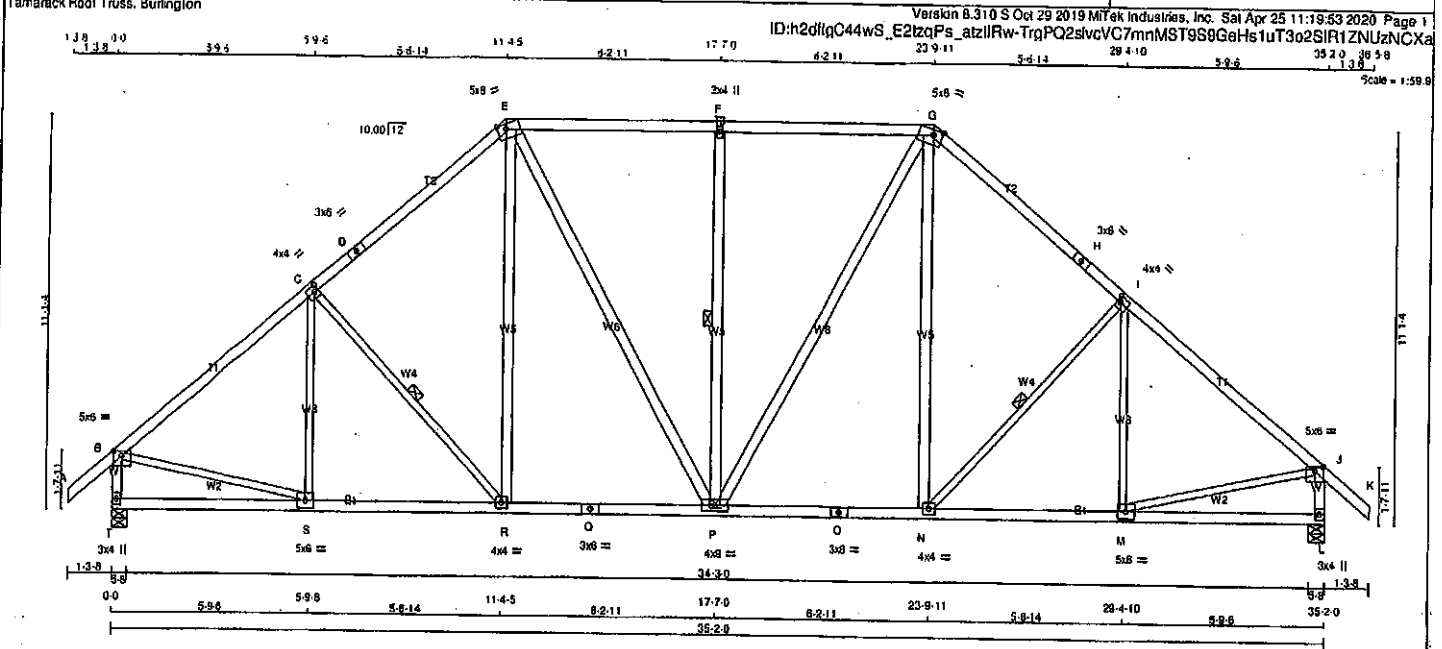

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER
A - D 2x4 DRY No.2
D - E 2x4 DRY No.2
E - G 2x4 DRY No.2
G - H 2x4 DRY No.2
H - K 2x4 DRY No.2
T - B 2x4 DRY No.2
L - J 2x4 DRY No.2
T - Q 2x4 DRY No.2
Q - O 2x4 DRY No.2
O - L 2x4 DRY No.2
ALL WEBS 2x4 DRY No.2
EXCEPT
S - C 2x3 DRY No.2
C - R 2x3 DRY No.2
N - I 2x3 DRY No.2
M - J 2x3 DRY No.2
M - S 2x3 DRY No.2
M - J 2x3 DRY No.2
DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
BEARINGS		GROSS REACTION		DOWN		UP		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
T	2086	0	2086	0	0	5-8	5-8	5-8	5-8
L	2086	0	2086	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		MAX/MIN. COMPONENT REACTIONS		1ST CASE		2ND CASE		3RD CASE	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	JT	COMBINED
T	1458	871 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0	T	1458
L	1458	871 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0	L	1458

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L
BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.27 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.
1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-R, F-P, I-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS
MAX. FACTORED
MEMB. FORCE (LBS)

WEBS
MAX. FACTORED
MEMB. FORCE (LBS)

FR-TO
FROM TO
A-B 0 / 41
B-C -2038 / 0
C-D -1844 / 0
D-E -1844 / 0
E-F -1621 / 0
F-G -1621 / 0
G-H -1844 / 0
H-I -1844 / 0
I-J -2038 / 0
J-K 0 / 41
K-L -2021 / 0
L-M -2021 / 0

MAX. FACTORED
VERT. LOAD (LBS)
1.01 (1)
0.50 (1)
0.48 (1)
0.50 (1)
0.50 (1)
0.48 (1)
0.48 (1)
0.48 (1)
0.50 (1)
0.50 (1)
0.50 (1)
0.50 (1)

MAX. FACTORED
CS (LC)
1.00
4.27
4.47
4.47
4.60
4.60
4.47
4.47
4.27
10.00
5.94
5.94

MAX. FACTORED
CS (LC)
0.17 (1)
0.15 (1)
0.05 (1)
0.08 (1)
0.45 (1)
0.08 (1)
0.05 (1)
0.15 (1)
0.17 (1)
0.37 (1)
0.37 (1)
0.37 (1)

MAX. FACTORED
CS (LC)
0.17 (1)
0.15 (1)
0.05 (1)
0.08 (1)
0.45 (1)
0.08 (1)
0.05 (1)
0.15 (1)
0.17 (1)
0.37 (1)
0.37 (1)
0.37 (1)

MAX. FACTORED
CS (LC)
0.17 (1)
0.15 (1)
0.05 (1)
0.08 (1)
0.45 (1)
0.08 (1)
0.05 (1)
0.15 (1)
0.17 (1)
0.37 (1)
0.37 (1)
0.37 (1)

MAX. FACTORED
CS (LC)
0.17 (1)
0.15 (1)
0.05 (1)
0.08 (1)
0.45 (1)
0.08 (1)
0.05 (1)
0.15 (1)
0.17 (1)
0.37 (1)
0.37 (1)
0.37 (1)

MAX. FACTORED
CS (LC)
0.17 (1)
0.15 (1)
0.05 (1)
0.08 (1)
0.45 (1)
0.08 (1)
0.05 (1)
0.15 (1)
0.17 (1)
0.37 (1)
0.37 (1)
0.37 (1)

MAX. FACTORED
CS (LC)
0.17 (1)
0.15 (1)
0.05 (1)
0.08 (1)
0.45 (1)
0.08 (1)
0.05 (1)
0.15 (1)
0.17 (1)
0.37 (1)
0.37 (1)
0.37 (1)

MAX. FACTORED
CS (LC)
0.17 (1)
0.15 (1)
0.05 (1)
0.08 (1)
0.45 (1)
0.08 (1)
0.05 (1)
0.15 (1)
0.17 (1)
0.37 (1)
0.37 (1)
0.37 (1)

MAX. FACTORED
CS (LC)
0.17 (1)
0.15 (1)
0.05 (1)
0.08 (1)
0.45 (1)
0.08 (1)
0.05 (1)
0.15 (1)
0.17 (1)
0.37 (1)
0.37 (1)
0.37 (1)

MAX. FACTORED
CS (LC)
0.17 (1)
0.15 (1)
0.05 (1)
0.08 (1)
0.45 (1)
0.08 (1)
0.05 (1)
0.15 (1)
0.17 (1)
0.37 (1)
0.37 (1)
0.37 (1)

MAX. FACTORED
CS (LC)
0.17 (1)
0.15 (1)
0.05 (1)
0.08 (1)
0.45 (1)
0.08 (1)
0.05 (1)
0.15 (1)
0.17 (1)
0.37 (1)
0.37 (1)
0.37 (1)


MAX. FACTORED
CS (LC)
0.17 (1)
0.15 (1)
0.05 (1)
0.08 (1)
0.45 (1)
0.08 (1)
0.05 (1)
0.15 (1)
0.17 (1)
0.37 (1)
0.37 (1)
0.37 (1)

MAX. FACTORED
CS (LC)
0.17 (1)
0.15 (1)
0.05 (1)
0.08 (1)
0.45 (1)
0.08 (1)
0.05 (1)
0.15 (1)
0.17 (1)
0.37 (1)
0.37 (1)
0.37 (1)

MAX. FACTORED
CS (LC)
0.17 (1)
0.15 (1)
0.05 (1)
0.08 (1)
0.45 (1)
0.08 (1)
0.05 (1)
0.15 (1)
0.17 (1)
0.37 (1)
0.37 (1)
0.37 (1)


MAX. FACTORED
CS (LC)
0.17 (1)
0.15 (1)
0.05 (1)
0.08 (1)
0.45 (1)
0.08 (1)
0.05 (1)
0.15 (1)
0.17 (1)
0.37 (1)
0.37 (1)
0.37 (1)

MAX. FACTORED
CS (LC)
0.17 (1)
0.15 (1)
0.05 (1)
0.08 (1)
0.45 (1)
0.08 (1)
0.05 (1)
0.15 (1)
0.17 (1)
0.37 (1)
0.37 (1)
0.37 (1)

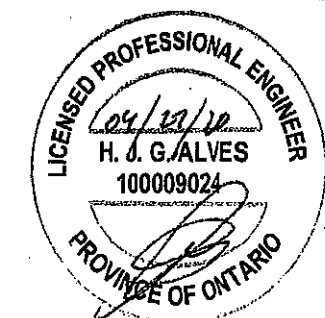

Structural component only
DWG# T-2007089

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408151	T28	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

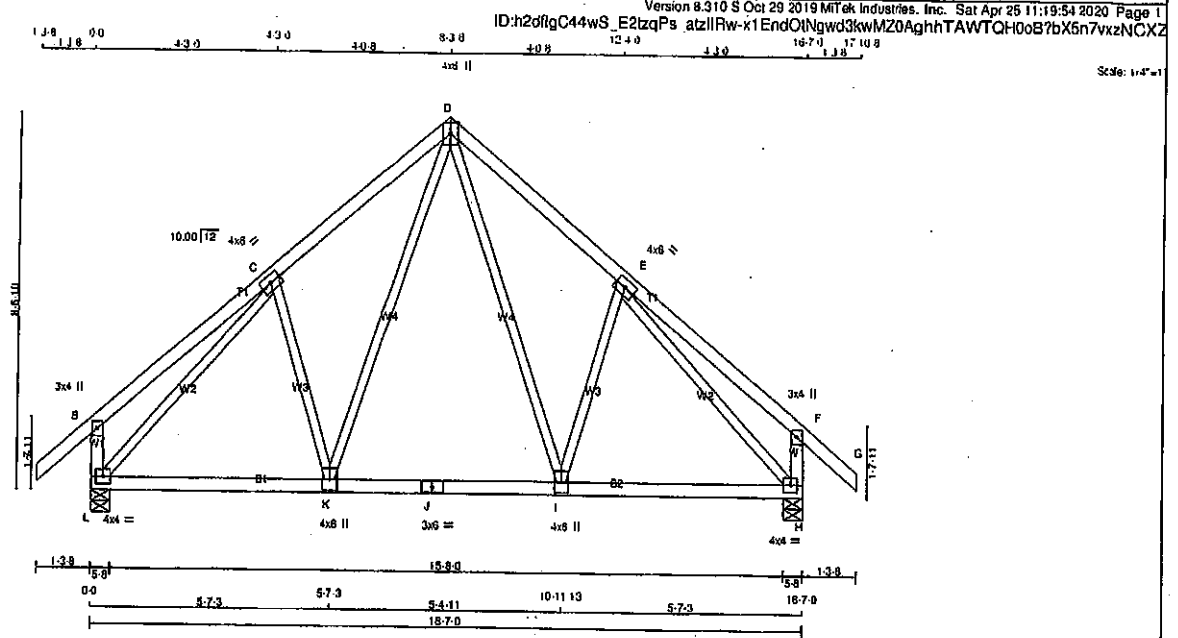

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - G	2x4	DRY	No.2	SPF		
L - B	2x4	DRY	No.2	SPF		
H - F	2x4	DRY	No.2	SPF		
L - J	2x4	DRY	No.2	SPF		
J - H	2x4	DRY	No.2	SPF		

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0			
C	TMVW-i	MT20	4.0	8.0			
D	TTWW+p	MT20	4.0	8.0			Edge
E	TMVW-i	MT20	4.0	8.0			
F	TMV+p	MT20	3.0	4.0			
H	BMVW-i	MT20	4.0	4.0			
I	BMVW-i	MT20	4.0	8.0			
J	BS-i	MT20	3.0	8.0			
K	BMVW-i	MT20	4.0	8.0			
L	BMVW-i	MT20	4.0	4.0			

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG
L	VERT	DOWN	UPLIFT	IN-SX
H	1041	0	0	5-8

UNFACTORED REACTIONS	1ST CASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED	SNOW
L	734	495 / 0
H	734	495 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED	FORCE	VERT. LOAD	LC1	MAX	CS1 (LC)	UNBRAC	LENGTH	FR-TO	MEMB.	MAX. FACTORED	FORCE	MAX	CS1 (LC)
A-B	0 / 41	-91.8	-91.8	0.13	(1)	10.00	0-1	0 / 339	0.08	(1)					
B-C	0 / 29	-91.8	-91.8	0.28	(1)	10.00	E-E	-222 / 0	0.09	(1)					
C-D	-764 / 0	-91.8	-91.8	0.20	(1)	6.25	K-D	0 / 339	0.08	(1)					
D-E	-764 / 0	-91.8	-91.8	0.20	(1)	6.25	C-K	-222 / 0	0.09	(1)					
E-F	0 / 29	-91.8	-91.8	0.28	(1)	10.00	L-C	-984 / 0	0.88	(1)					
F-G	0 / 41	-91.8	-91.8	0.13	(1)	10.00	E-H	-984 / 0	0.88	(1)					
L-B	-270 / 0	0.0	0.0	0.03	(1)	7.81									
H-F	-270 / 0	0.0	0.0	0.03	(1)	7.81									
L-K	0 / 632	-18.5	-18.5	0.18	(4)	10.00									
K-J	0 / 459	-18.5	-18.5	0.17	(4)	10.00									
J-I	0 / 459	-18.5	-18.5	0.17	(4)	10.00									
I-H	0 / 632	-18.5	-18.5	0.18	(4)	10.00									

TOTAL WEIGHT = 2 X 82 = 163 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C.G.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.55")
CALCULATED VERT. DEFL.(LL) = L/899 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.55")
CALCULATED VERT. DEFL.(TL) = L/899 (0.04")

CSI: TC=0.28/1.00 (B-C:1), BC=0.18/1.00 (H-I:4), WB=0.68/1.00 (E-H:1), SSI=0.14/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.78 (C) (INPUT = 0.90)
JSI METAL=0.28 (C) (INPUT = 1.00)

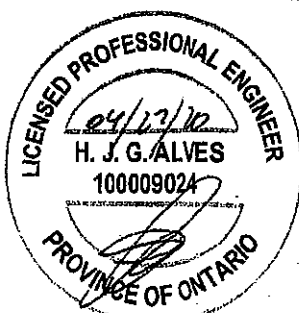

Structural component only
DWG# T-2007090

JOB NAME 408151	TRUSS NAME T29	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

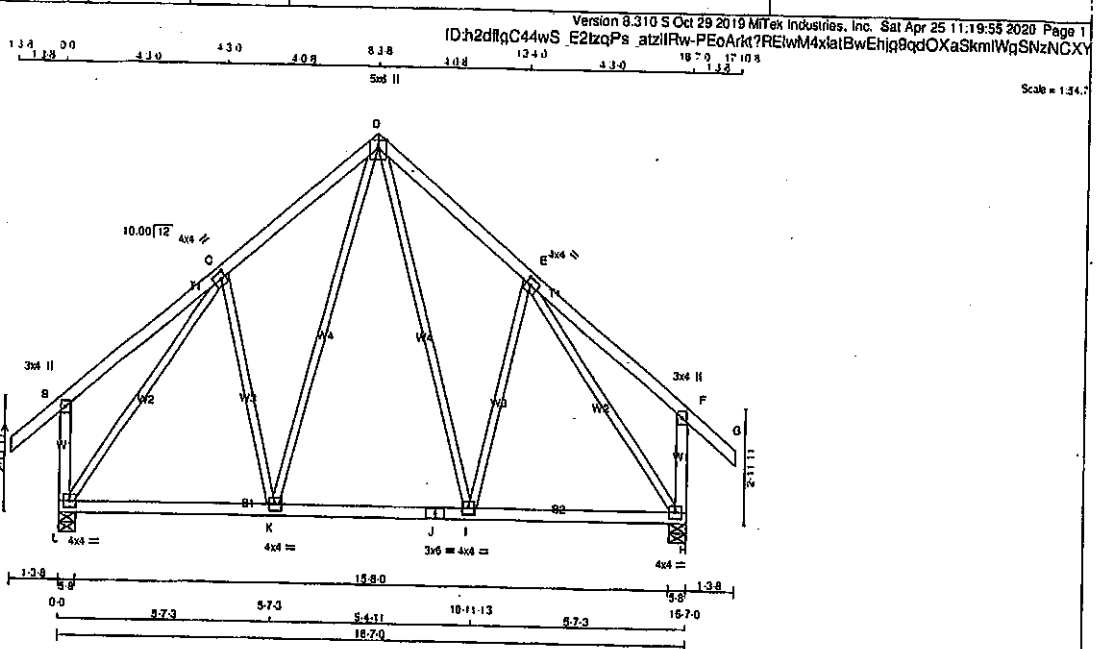

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
L - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMW+1	MT20	4.0	4.0	2.00	1.50
D	TTW+1	MT20	5.0	8.0	Edge	
E	TMW+1	MT20	4.0	4.0	2.00	1.50
F	TMV+p	MT20	3.0	4.0		
H	BMW+1	MT20	4.0	4.0		
I	BMW+1	MT20	4.0	4.0		
J	BS-1	MT20	3.0	8.0		
K	BMW+1	MT20	4.0	4.0		
L	BMW+1	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	REQD BRG IN-SX
JT	VERT	HORZ	DOWN	HORZ
L	1041	0	1041	0
H	1041	0	1041	0

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
L	734	485 / 0	0 / 0	0 / 0	239 / 0
H	734	485 / 0	0 / 0	0 / 0	239 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 / 41	-91.8 -91.8	0.13 (1)	10.00	D-I	0 / 254	0.08 (1)
B-C	0 / 28	-91.8 -91.8	0.26 (1)	10.00	I-E	-138 / 14	0.10 (1)
C-D	-833 / 0	-91.8 -91.8	0.20 (1)	6.25	K-D	0 / 254	0.08 (1)
D-E	-833 / 0	-91.8 -91.8	0.20 (1)	6.25	C-K	-138 / 14	0.10 (1)
E-F	0 / 28	-91.8 -91.8	0.26 (1)	10.00	L-C	-875 / 0	0.90 (1)
F-G	0 / 41	-91.8 -91.8	0.13 (1)	10.00	E-H	-875 / 0	0.90 (1)
L-B	-278 / 0	0.0 0.0	0.04 (1)	7.81			
H-F	-278 / 0	0.0 0.0	0.04 (1)	7.81			
L-K	0 / 495	-18.5 -18.5	0.17 (4)	10.00			
K-J	0 / 395	-18.5 -18.5	0.16 (4)	10.00			
J-I	0 / 395	-18.5 -18.5	0.16 (4)	10.00			
I-H	0 / 495	-18.5 -18.5	0.17 (4)	10.00			

TOTAL WEIGHT = 91 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
OL = 6.0 PSF
BOT CH. LL = 0.0 PSF
OL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.55")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/380 (0.55")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.28/1.00 (E-F:1), BC=0.17/1.00 (K-L:4),
WB=0.90/1.00 (E-H:1), SSI=0.14/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1937 1056

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (E) (INPUT = 0.90)
JSI METAL= 0.34 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007091

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408151	T30	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

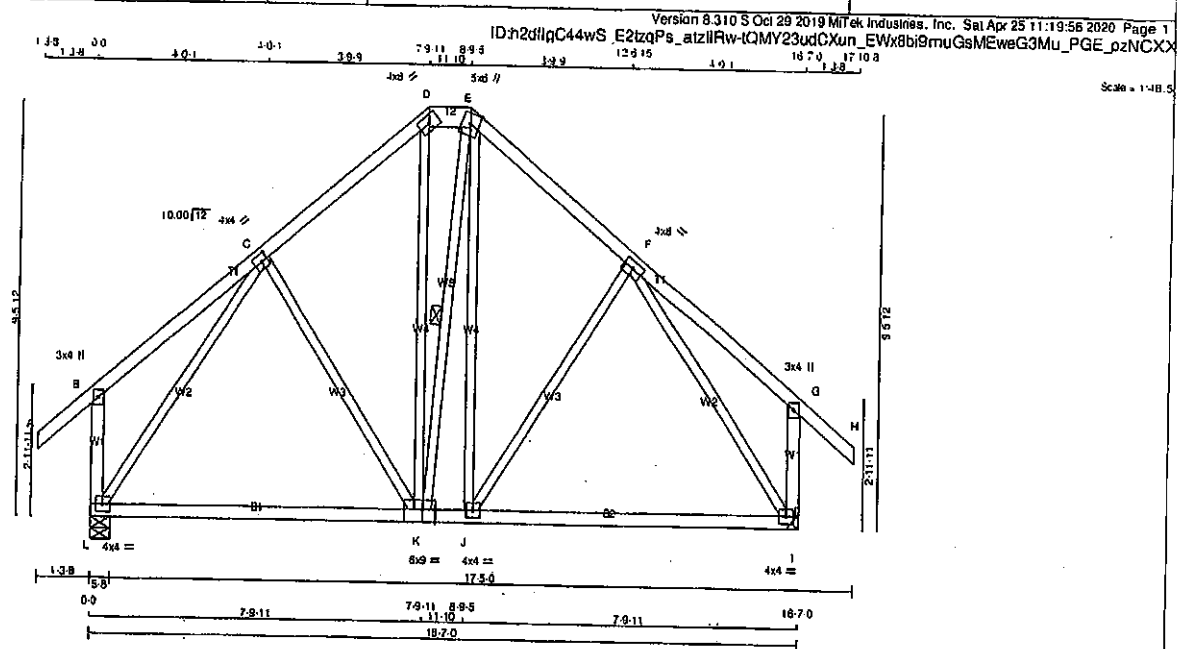

LUMBER	N. L. G. A. RULES	SIZE	LUMBER
CHORDS			
A - D	2x4	DRY	No.2
D - E	2x6	DRY	No.2
E - H	2x4	DRY	No.2
L - B	2x4	DRY	No.2
I - G	2x4	DRY	No.2
L - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWV-t	MT20	4.0	4.0	2.00	1.75
D	TTW-h	MT20	4.0	6.0		
E	TTWV+m	MT20	5.0	6.0	Edge	
F	TMWV-t	MT20	4.0	6.0		
G	TMV+p	MT20	3.0	4.0		
I	BMVW-1	MT20	4.0	4.0		
J	BMVW-1	MT20	4.0	4.0		
K	BSWVW-1	MT20	6.0	9.0	Edge	3.75
L	BMVW-1	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	RECORD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
L	1041	0	1041	0	5-8	5-8
I	1041	0	1041	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3-8.

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	734	495 / 0	0 / 0	0 / 0	0 / 0	239 / 0	0 / 0
I	734	495 / 0	0 / 0	0 / 0	0 / 0	239 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)
FR-TO		FROM TO		FR-TO			
A-B	0 / 41	-91.8	-91.8 0.13 (1)	C-K	-98 / 9		0.09 (1)
B-C	0 / 27	-91.8	-91.8 0.23 (1)	K-D	0 / 164		0.04 (1)
C-D	-566 / 0	-91.8	-91.8 0.18 (1)	J-E	-109 / 0		0.07 (4)
D-E	-414 / 0	-91.8	-91.8 0.01 (1)	K-F	0 / 288		0.07 (4)
E-F	-582 / 0	-91.8	-91.8 0.18 (1)	J-F	-93 / 15		0.09 (1)
F-G	0 / 27	-91.8	-91.8 0.23 (1)	L-C	-848 / 0		0.78 (1)
G-H	0 / 41	-91.8	-91.8 0.13 (1)	F-I	-882 / 0		0.79 (1)
L-B	-285 / 0	0.0	0.0 0.04 (1)				
I-G	-285 / 0	0.0	0.0 0.04 (1)				
L-K	0 / 468	-18.5	-18.5 0.38 (4)				
K-J	0 / 424	-18.5	-18.5 0.30 (4)				
J-I	0 / 477	-18.5	-18.5 0.30 (4)				

TOTAL WEIGHT = 97 lb

(MIP)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
DL	=	8.0	PSF	
BOT CH.	LL	=	0.0	PSF
DL	=	7.4	PSF	
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.55")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.55")
CALCULATED VERT. DEFL.(TL) = L/999 (0.17")

CSI: TC=0.23/1.00 (B-C:1), BC=0.38/1.00 (K-L:4), WB=0.79/1.00 (F-I:1), SS=0.14/1.00 (J-K:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	818	354	1667
	788	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.89 (C) (INPUT = 0.90)
JSI METAL=0.31 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007092

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408151	T31	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

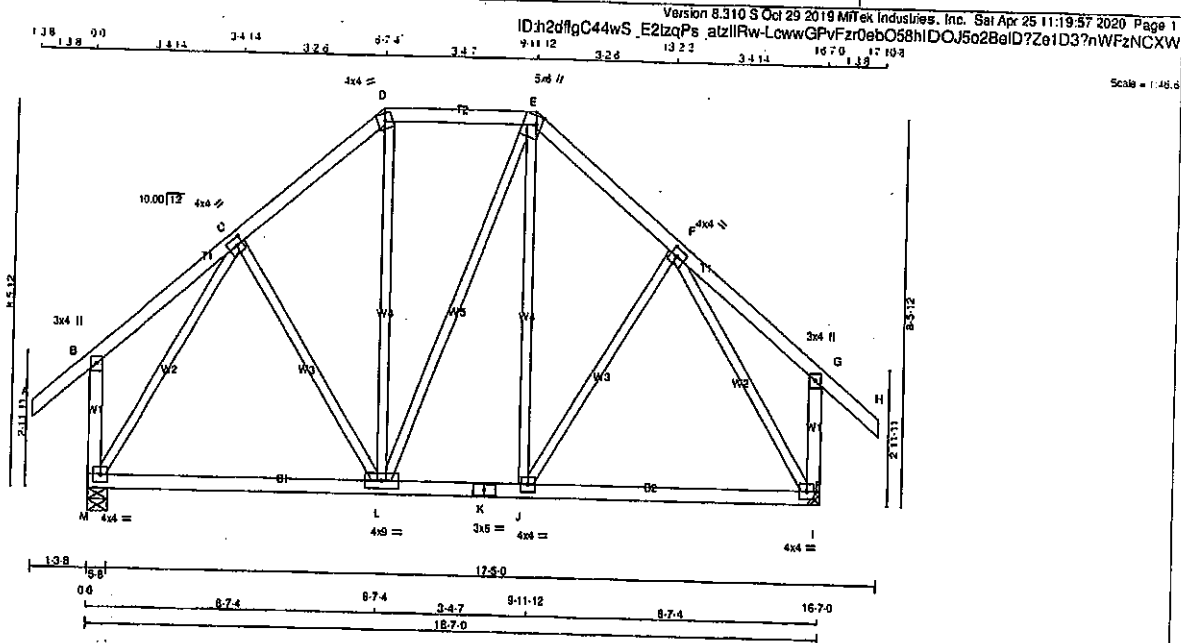

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHOROS			
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - H	2x4	DRY	No.2
M - B	2x4	DRY	No.2
I - G	2x4	DRY	No.2
M - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (Table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV-p	MT20	3.0	4.0		
C TMWV-1	MT20	4.0	4.0	2.00	1.75
D TTW-m	MT20	4.0	4.0		
E TTWV-m	MT20	5.0	5.0	2.25	1.50
F TMWV-1	MT20	4.0	4.0	2.00	1.75
G TMV-p	MT20	3.0	4.0		
I BMWV-1	MT20	4.0	4.0		
J BMWV-1	MT20	4.0	4.0		
K BS-1	MT20	3.0	4.0		
L BMWV-1	MT20	4.0	4.0		
M BMWV-1	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
M	1041	0	1041	0	5-8
I	1041	0	1041	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3-8.

UNFACTORED REACTIONS

JT	1ST LOSE	MAX./MIN. SNOW	MAX./MIN. LIVE	PERM. LIVE	WIND	DEAD	SOIL
M	734	495/0	0/0	0/0	0/0	239/0	0/0
I	734	495/0	0/0	0/0	0/0	239/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO				FR-TO	
A-B	0/41	-91.8	-91.8 0.13 (1)	C-L	-10/34
B-C	0/22	-91.8	-91.8 0.16 (1)	L-O	0/110
C-D	-613/0	-91.8	-91.8 0.13 (1)	L-E	0/0
D-E	-453/0	-91.8	-91.8 0.14 (1)	J-E	0/109
E-F	-612/0	-91.8	-91.8 0.13 (1)	J-F	-11/34
F-G	0/22	-91.8	-91.8 0.16 (1)	M-C	-873/0
G-H	0/41	-91.8	-91.8 0.13 (1)	F-I	-873/0
M-B	-245/0	0.0	0.0 0.04 (1)		
I-G	-245/0	0.0	0.0 0.04 (1)		
M-L	0/457	-18.5	-18.5 0.21 (4)		
L-K	0/453	-18.5	-18.5 0.20 (4)		
K-J	0/453	-18.5	-18.5 0.20 (4)		
J-I	0/457	-18.5	-18.5 0.21 (4)		

TOTAL WEIGHT = 92 lb
(M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.55")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.55")
CALCULATED VERT. DEFL. (TL) = L/999 (0.07")

CS1: TC=0.18/1.00 (F-G:1), 8C=0.21/1.00 (J-K:1),
WB=0.80/1.00 (C-M:1), SS1=0.12/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (C) (INPUT = 0.90)
JSI METAL = 0.31 (C) (INPUT = 1.00)

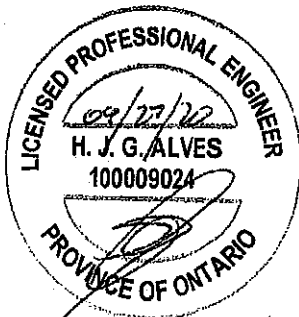

Structural component only
DWG# T-2007093

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408151	T32	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:19:58 2020 Page 1					
ID:h2df1gC44wS_E2tzqPs_atzIRw-ppU1T1wK98VDYgKFoldrJL81210k8OBSjIK2izNCXV					
Scale: 1/4" = 1'-0"					

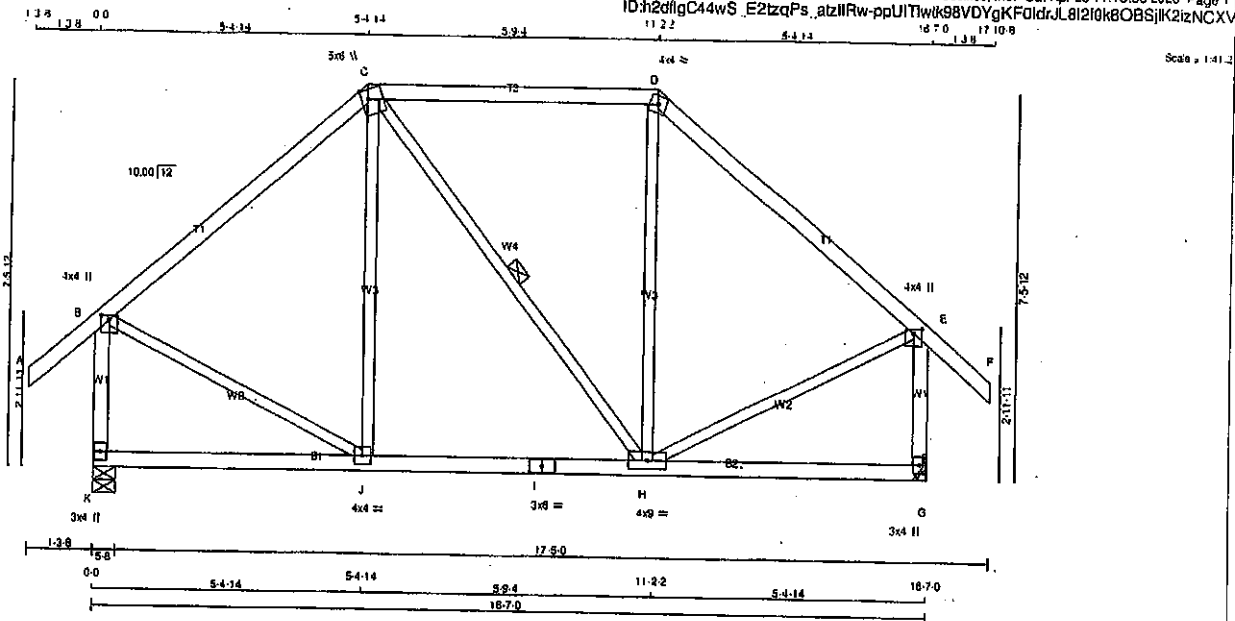

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
K - B	2x4	DRY	No.2
G - E	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTWW+m	MT20	5.0	6.0	2.25	1.50
D	TTW-m	MT20	4.0	4.0		
E	TMVW+p	MT20	4.0	4.0	1.00	2.00
G	BMV1+p	MT20	3.0	4.0		
H	BMVWW-t	MT20	4.0	9.0		
I	BS-I	MT20	3.0	6.0		
J	BMVW-t	MT20	4.0	4.0		
K	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	DOWN	HORIZ	BRG	IN-SX	BRG	IN-SX
K	1041	0	1041	0	5-8	5-8	
G	1041	0	1041	0	0	0	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
K	734	495/0	0/0	0/0	0/0	239/0	0/0
G	734	495/0	0/0	0/0	0/0	239/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-H.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEB S		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CS1 (LC)	MEMB.	FORCE (LBS)	CS1 (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0/41	-91.8	-91.8 0.13 (1)	10.00	J-C	-115/48	0.12 (1)
B-C	-619/0	-91.8	-91.8 0.35 (1)	8.25	C-H	0/0	0.00 (1)
C-D	-473/0	-91.8	-91.8 0.39 (1)	6.25	H-D	-115/48	0.12 (1)
D-E	-619/0	-91.8	-91.8 0.35 (1)	6.25	B-J	0/526	0.12 (1)
E-F	0/41	-91.8	-91.8 0.13 (1)	10.00	H-E	0/526	0.12 (1)
K-B	-1000/0	0.0	0.0 0.16 (1)	7.81			
G-E	-1000/0	0.0	0.0 0.16 (1)	7.81			
K-J	0/0	-18.5	-18.5 0.13 (4)	10.00			
J-I	0/473	-18.5	-18.5 0.17 (4)	10.00			
I-H	0/473	-18.5	-18.5 0.17 (4)	10.00			
H-G	0/0	-18.5	-18.5 0.13 (4)	10.00			

TOTAL WEIGHT = 79 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	8.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. O/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 085-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.55")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.01")
ALLOWABLE DEFL. (TL) = $L/360$ (0.55")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.03")

CSI: TC=0.39/1.00 (C-D:1), BC=0.17/1.00 (H-J:4), WB=0.12/1.00 (B-J:1), SSI=0.21/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)
MT20	616	354
	1667	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.82 (B) (INPUT = 0.90)
JSI METAL = 0.23 (B) (INPUT = 1.00)

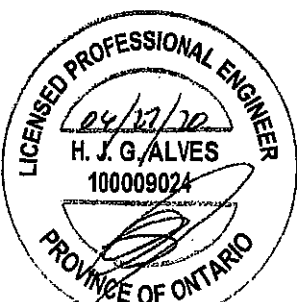

Structural component only
DWG# T-2007094

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408151	G33	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:19:40 2020 Page 1	

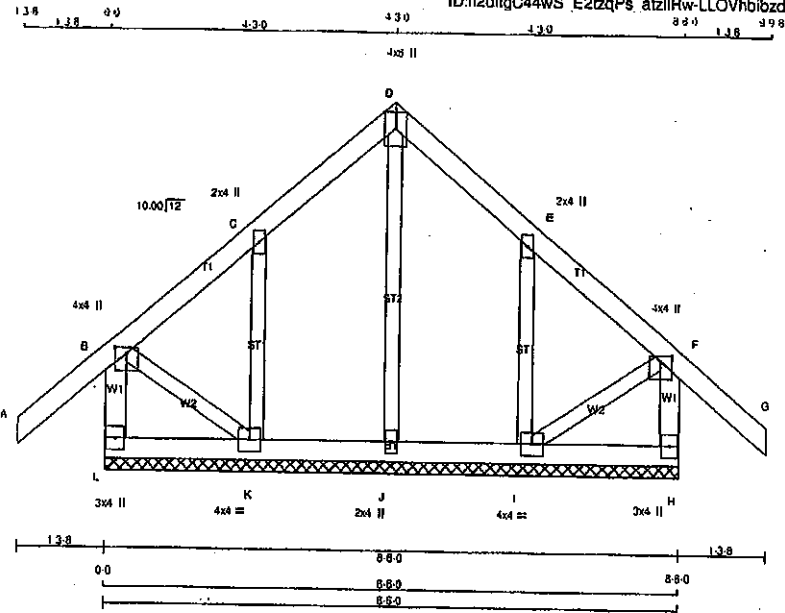

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
L - B	2x4	DRY	No.2
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2'-0" O.C.

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
C	TMVW+w	MT20	2.0	4.0	
D	TTW+p	MT20	4.0	8.0	Edge
E	TMVW+w	MT20	2.0	4.0	
F	TMVW+p	MT20	4.0	4.0	1.00 2.00
H	BMV1+p	MT20	3.0	4.0	
I	BMVW1-i	MT20	4.0	4.0	
J	BMV1+w	MT20	2.0	4.0	
K	BMVW1-i	MT20	4.0	4.0	
L	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM TO		FR-TO			
L-B	-231 / 0	0.0	0.0 0.02 (1)	J-D	-123 / 0	0.05 (1)	
A-B	0 / 41	-91.8	-91.8 0.13 (1)	K-C	-236 / 0	0.05 (1)	
B-C	-11 / 0	-91.8	-91.8 0.07 (1)	I-E	-236 / 0	0.05 (1)	
C-D	-32 / 0	-91.8	-91.8 0.07 (1)	B-K	0 / 23	0.01 (1)	
D-E	-32 / 0	-91.8	-91.8 0.07 (1)	I-F	0 / 23	0.01 (1)	
E-F	-11 / 0	-91.8	-91.8 0.07 (1)				
F-G	0 / 41	-91.8	-91.8 0.13 (1)				
H-F	-231 / 0	0.0	0.0 0.02 (1)				
L-K	0 / 0	-18.5	-18.5 0.02 (4)				
K-J	0 / 13	-18.5	-18.5 0.02 (4)				
J-I	0 / 13	-18.5	-18.5 0.02 (4)				
I-H	0 / 0	-18.5	-18.5 0.02 (4)				

TOTAL WEIGHT = 42 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.13/1.00 (F-G:1), BC=0.02/1.00 (J-K:4), WB=0.05/1.00 (C-K:1), SS=0.08/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
	(PSI)	(PLI)	(PLI)		
MT20	618	354	1667	788	1987 1658

PLATE PLACEMENT TOL. = 0.250 Inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (C) (INPUT = 0.90)
JSI METAL= 0.13 (C) (INPUT = 1.00)

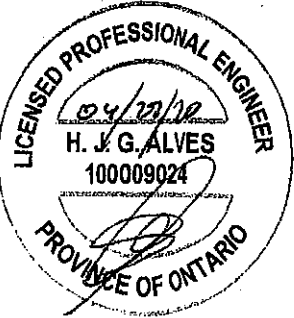

Structural component only
DWG# T-2007078

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408151	T33X	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 11:19:59 2020 Page 1	

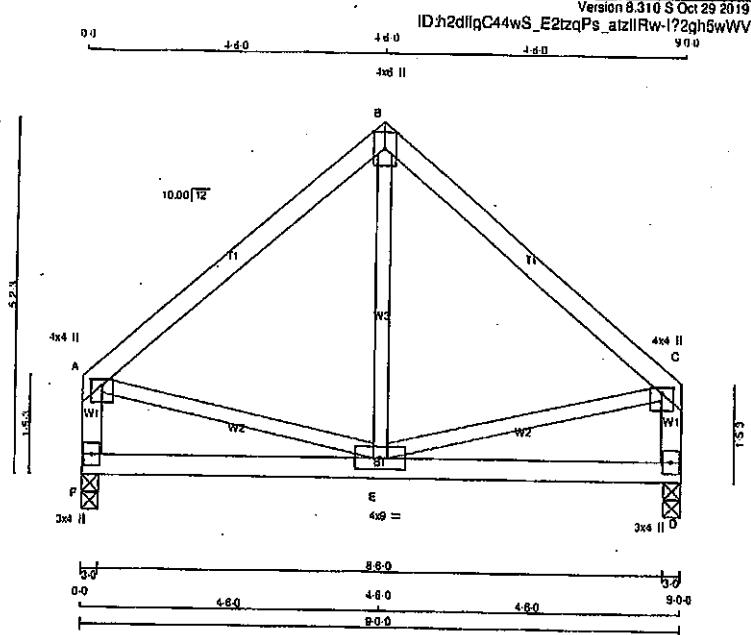

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
F - A	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.00	2.00
B	TTW+p	MT20	4.0	6.0	Edge	
C	TMVW+p	MT20	4.0	4.0	1.00	2.00
D	BMV1+p	MT20	3.0	4.0		
E	BMVWW-l	MT20	4.0	9.0		
F	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UPLIFT
F	496	0	496	0
D	496	0	496	0

UNFACTORED REACTIONS							
JT	1ST LOASE	MAX/MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SO
F	351	230 / 0	0 / 0	0 / 0	0 / 0	121 / 0	0 / 0
D	351	230 / 0	0 / 0	0 / 0	0 / 0	121 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, D

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LOAD (1)	MAX. LOAD (2)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LOAD (1)	MAX. LOAD (2)
A-B	FR-TO	-311 / 0	-91.8	-91.8	0.24 (1)	6.25	E-B	-14 / 72	0.03 (4)	
B-C	FR-TO	-311 / 0	-91.8	-91.8	0.24 (1)	6.25	A-E	0 / 246	0.06 (1)	
F-A	FR-TO	-464 / 0	0.0	0.0	0.05 (1)	7.81	E-C	0 / 248	0.06 (1)	
D-C	FR-TO	-464 / 0	0.0	0.0	0.05 (1)	7.81				
F-E	FR-TO	0 / 0	-18.5	-18.5	0.11 (4)	10.00				
E-D	FR-TO	0 / 0	-18.5	-18.5	0.11 (4)	10.00				

TOTAL WEIGHT = 37 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.30")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.30")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.24/1.00 (A-B:1), BC=0.11/1.00 (E-F:4), WB=0.06/1.00 (C-E:1), SS=0.12/1.00 (A-B:1)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	818	354	1687 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.42 (A) (INPUT = 0.90)
JSI METAL= 0.12 (A) (INPUT = 1.00)

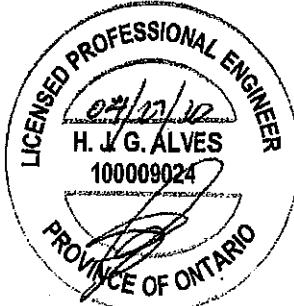


Structural component only
DWG# T-2007095

Structural component only
DWG# T-2007096

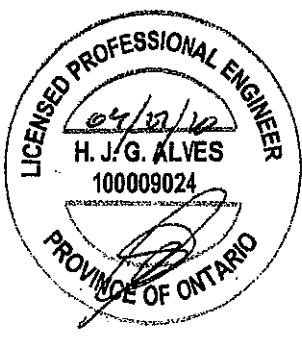JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.														
408151	T35	2	2	GREEN PARK HOMES															
Tamarack Roof Truss, Burlington				Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:20:01 2020 Page 2 ID:h2df1gC44wS E2tqPs atzIRw-EO9R5nym13W447Qvw8IKTxzhdFf xTUD8gz 1fzNCXS															
PLATES (table is in inches) <table><thead><tr><th>JT</th><th>TYPE</th><th>PLATES</th><th>W</th><th>LEN</th><th>Y</th><th>X</th></tr></thead><tbody><tr><td>F</td><td>BMV1+p</td><td>MT20</td><td>3.0</td><td>4.0</td><td></td><td></td></tr></tbody></table>						JT	TYPE	PLATES	W	LEN	Y	X	F	BMV1+p	MT20	3.0	4.0		
JT	TYPE	PLATES	W	LEN	Y	X													
F	BMV1+p	MT20	3.0	4.0															
 Structural component only DWG# T-2007097 2/2																			

JOB NAME 408151	TRUSS NAME G36	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 11:19:41 2020 Page 1
ID:h2df1gC44wS E2tqPs_atlRw-pXytwjDkw?vhws3lhxek8KIBIVFSmhYZ7xyBzNCXm

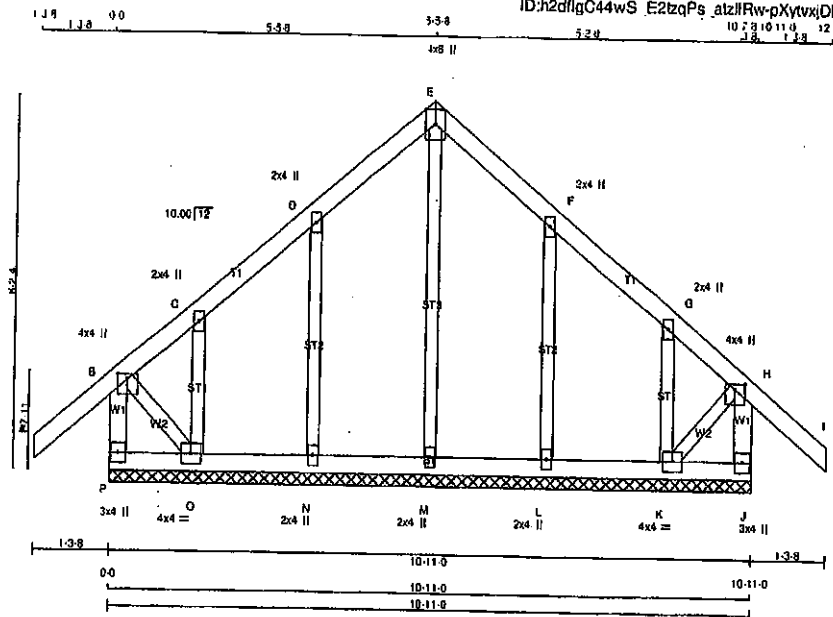

Scale = 1/32"

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER
P - B	2x4	DRY	No.2
A - E	2x4	DRY	No.2
E - I	2x4	DRY	No.2
J - H	2x4	DRY	No.2
P - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2'-0" O.C.

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
C, D, F, G					
C	TMVW+w	MT20	2.0	4.0	
E	TTW+p	MT20	4.0	6.0	Edge
H	TMVW+p	MT20	4.0	4.0	1.00 2.00
J	BMV1+p	MT20	3.0	4.0	
K	BMVW1-i	MT20	4.0	4.0	
L, M, N					
L	BMV1+w	MT20	2.0	4.0	
O	BMVW1-i	MT20	4.0	4.0	
P	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	FACTORED LC1 MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO					FR-TO		
P-B	-274 / 0	0.0	0.0 0.03 (1)	7.81	M-E	-139 / 0	0.08 (1)
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00	N-D	-223 / 0	0.07 (1)
B-C	-57 / 0	-91.8	-91.8 0.12 (1)	6.25	O-C	-75 / 0	0.01 (1)
C-D	-4 / 0	-91.8	-91.8 0.08 (1)	10.00	L-F	-223 / 0	0.07 (1)
D-E	-22 / 0	-91.8	-91.8 0.08 (1)	8.25	K-G	-75 / 0	0.01 (1)
E-F	-22 / 0	-91.8	-91.8 0.08 (1)	8.25	G-O	0 / 20	0.00 (1)
F-G	-4 / 0	-91.8	-91.8 0.06 (1)	10.00	K-H	0 / 20	0.00 (1)
G-H	-57 / 0	-91.8	-91.8 0.12 (1)	8.25			
H-I	0 / 41	-91.8	-91.8 0.13 (1)	10.00			
J-H	-274 / 0	0.0	0.0 0.03 (1)	7.81			
P-O	0 / 0	-18.5	-18.5 0.01 (4)	10.00			
O-N	0 / 12	-18.5	-18.5 0.02 (4)	10.00			
N-M	0 / 7	-18.5	-18.5 0.02 (4)	10.00			
M-L	0 / 7	-18.5	-18.5 0.02 (4)	10.00			
L-K	0 / 12	-18.5	-18.5 0.02 (4)	10.00			
K-J	0 / 0	-18.5	-18.5 0.01 (4)	10.00			

TOTAL WEIGHT = 53 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.8	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.13/1.00 (H-I), BC=0.02/1.00 (K-L), WB=0.08/1.00 (E-M), SSI=0.08/1.00 (A-B-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MT20	618	354	1687 788 1687 1688

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.21 (B) (INPUT = 0.90)
JSI METAL= 0.12 (F) (INPUT = 1.00)

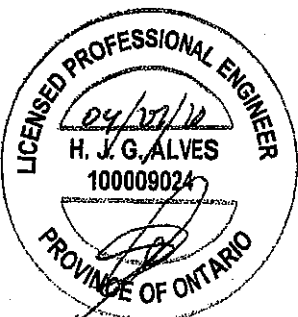

Structural component only
DWG# T-2007079

JOB NAME 408152	TRUSS NAME T40	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:28:32 2020 Page 1				ID:17vF7aG0E03cRUj6X1j8kzIWYK-0EAix1sxZWS34IYtZ2E6M8CTQSHDeTgR0nICQzNCOX	
Scale = 1:57.3					

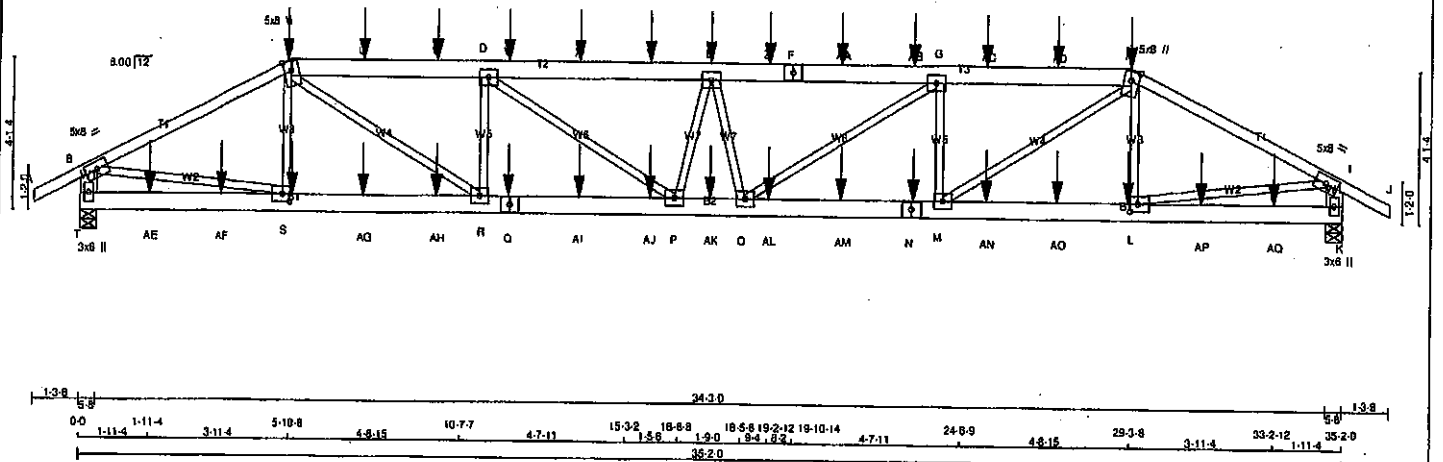

LUMBER	N. L. G. A. RULES	SIZE	LUMBER	DESC.
CHORDS				
A - C	2x4	DRY	No.2	SPF
C - F	2x6	DRY	No.2	SPF
F - H	2x6	DRY	No.2	SPF
H - J	2x4	DRY	No.2	SPF
T - B	2x6	DRY	No.2	SPF
K - I	2x6	DRY	No.2	SPF
T - Q	2x6	DRY	No.2	SPF
Q - N	2x6	DRY	No.2	SPF
N - K	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - G 1	12	SIDE (81.0)
H - J 1	12	SIDE (81.0)
C - F 2	12	SIDE (81.0)
F - H 2	12	SIDE (81.0)
T - B 2	12	TOP
K - I 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
T - Q 2	12	SIDE (183.1)
Q - N 2	12	SIDE (0.0)
N - K 2	12	SIDE (183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	GROSS REACTION	GROSS REACTION	GROSS REACTION	BRG	BRG	BRG	BRG	BRG	BRG
T	3331	0	3331	0	0	5-8	5-8	5-8	5-8
K	3331	0	3331	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
T	2356	1844 / 0	0 / 0	0 / 0	0 / 0	0 / 0	812 / 0	0 / 0
K	2356	1844 / 0	0 / 0	0 / 0	0 / 0	0 / 0	812 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.87 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. (PLF)	CS1 (LC)	UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX. (LBS)	CS1 (LC)
FR-TO		FROM	TO			FR-TO			
A - B	0 / 28	-91.8	-91.8	0.07 (1)	10.00	S - C	-427 / 8	0.05 (1)	
B - C	-5077 / 0	-91.8	-91.8	0.52 (1)	3.87	C - R	0 / 3083	0.38 (1)	
C - U	-7106 / 0	-91.8	-91.8	0.23 (1)	4.33	R - D	-1565 / 0	0.19 (1)	
U - V	-7106 / 0	-91.8	-91.8	0.23 (1)	4.33	O - G	0 / 1071	0.13 (1)	
V - D	-7106 / 0	-91.8	-91.8	0.27 (1)	4.33	M - G	-1585 / 0	0.19 (1)	
D - W	-7994 / 0	-91.8	-91.8	0.27 (1)	4.10	L - H	-427 / 8	0.05 (1)	
W - X	-7994 / 0	-91.8	-91.8	0.27 (1)	4.10	B - S	0 / 4592	0.57 (1)	
X - Y	-7994 / 0	-91.8	-91.8	0.27 (1)	4.10	L - I	0 / 4592	0.57 (1)	
Y - E	-7994 / 0	-91.8	-91.8	0.27 (1)	4.10	D - P	0 / 1071	0.13 (1)	
E - Z	-7994 / 0	-91.8	-91.8	0.27 (1)	4.10	M - H	0 / 3083	0.38 (1)	
Z - F	-7994 / 0	-91.8	-91.8	0.27 (1)	4.10	P - E	-505 / 0	0.06 (1)	
F - AA	-7994 / 0	-91.8	-91.8	0.27 (1)	4.10	E - O	-505 / 0	0.06 (1)	
AA - AB	-7994 / 0	-91.8	-91.8	0.27 (1)	4.10				
AB - G	-7994 / 0	-91.8	-91.8	0.27 (1)	4.10				
G - AC	-7106 / 0	-91.8	-91.8	0.23 (1)	4.33				
AC - AD	-7106 / 0	-91.8	-91.8	0.23 (1)	4.33				
AD - H	-7106 / 0	-91.8	-91.8	0.23 (1)	4.33				
H - I	-5077 / 0	-91.8	-91.8	0.52 (1)	3.87				
I - J	0 / 28	-91.8	-91.8	0.07 (1)	10.00				
T - B	-3255 / 0	0.0	0.0	0.11 (1)	7.69				
K - I	-3255 / 0	0.0	0.0	0.11 (1)	7.69				
T - AE	0 / 0	-18.5	-18.5	0.06 (4)	10.00				
AE - AF	0 / 0	-18.5	-18.5	0.06 (4)	10.00				
AF - S	0 / 0	-18.5	-18.5	0.06 (4)	10.00				
S - AG	0 / 4583	-18.5	-18.5	0.34 (1)	10.00				
AG - AH	0 / 4583	-18.5	-18.5	0.34 (1)	10.00				
AH - R	0 / 4583	-18.5	-18.5	0.34 (1)	10.00				
R - Q	0 / 7105	-18.5	-18.5	0.52 (1)	10.00				
Q - AI	0 / 7105	-18.5	-18.5	0.52 (1)	10.00				
AI - AJ	0 / 7105	-18.5	-18.5	0.52 (1)	10.00				
AJ - P	0 / 7105	-18.5	-18.5	0.52 (1)	10.00				
P - AK	0 / 8119	-18.5	-18.5	0.66 (1)	10.00				
AK - O	0 / 8119	-18.5	-18.5	0.66 (1)	10.00				
O - AL	0 / 7105	-18.5	-18.5	0.52 (1)	10.00				
AL - AM	0 / 7105	-18.5	-18.5	0.52 (1)	10.00				
AM - N	0 / 7105	-18.5	-18.5	0.52 (1)	10.00				
N - M	0 / 7105	-18.5	-18.5	0.52 (1)	10.00				
M - AN	0 / 4563	-18.5	-18.5	0.34 (1)	10.00				
AN - AO	0 / 4563	-18.5	-18.5	0.34 (1)	10.00				
AO - L	0 / 4563	-18.5	-18.5	0.34 (1)	10.00				
L - AP	0 / 0	-18.5	-18.5	0.06 (4)	10.00				
AP - AO	0 / 0	-18.5	-18.5	0.06 (4)	10.00				

TOTAL WEIGHT = 2 X 170 = 341 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.39")
CSK TC=0.52/1.00 (H-I), BC=0.58/1.00 (D-P), WB=0.57/1.00 (B-S-I), SS=0.16/1.00 (D-E-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES


PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL = 0.250 Inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.84 (S) (INPUT = 0.90)

JSI METAL = 0.64 (N) (INPUT = 1.00)

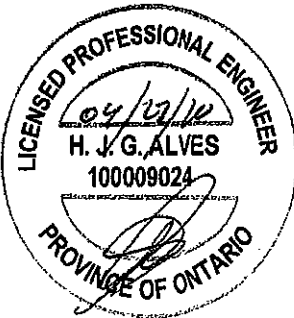

Structural component only
DWG# T-2007107 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	T40	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:32 2020 Page 2
ID:J7vF7aG0E03cRUj6X1ISikzWYK-0EA1x1sxZWS34IYeZ2E6M6CTQSHDeTgR0niCQzNCOX


PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	5.0	8.0	
C	TTWW-m	MT20	5.0	8.0	Edge
D, E, G					
D	TMVW-t	MT20	5.0	8.0	
F	TS-t	MT20	5.0	8.0	
H	TTWW-m	MT20	5.0	8.0	Edge
I	TMVW-t	MT20	5.0	8.0	
K	BMV1+p	MT20	3.0	8.0	
L	BMVW-t	MT20	5.0	8.0	2.50 2.50
M, O, P, R					
M	BMVW-t	MT20	5.0	8.0	
N	BS-t	MT20	5.0	8.0	
Q	BS-t	MT20	5.0	8.0	
S	BMVW-t	MT20	5.0	8.0	2.50 2.50
T	BMV1+p	MT20	3.0	8.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.


LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.		MAX. FACTORED FORCE (LBS)		FACTORED VERT. LOAD (PLF)	MAX. MEMB. FORCE (LBS)		MAX. FACTORED UNBRAC. LENGTH (LC)		
FR-TO		FROM	TO		FR-TO		FROM	TO	
AD-K	0:0	-18.5	-18.5	0.08 (4)	10.00				
FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-438	-438	---	FRONT	VERT	TOTAL	---	C1
E	17-7-0	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	29-3-8	-438	-438	---	FRONT	VERT	TOTAL	---	C1
L	28-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
N	23-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Q	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
S	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
U	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	19-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	21-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	1-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AF	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	15-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	17-7-0	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AL	19-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AM	21-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AN	23-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AO	25-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AP	27-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AQ	33-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

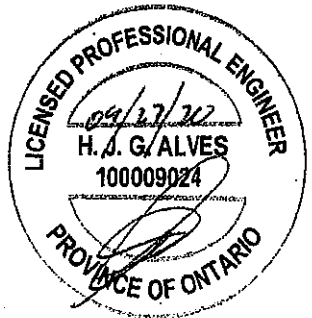

Structural component only
DWG# T-2007107 2/2

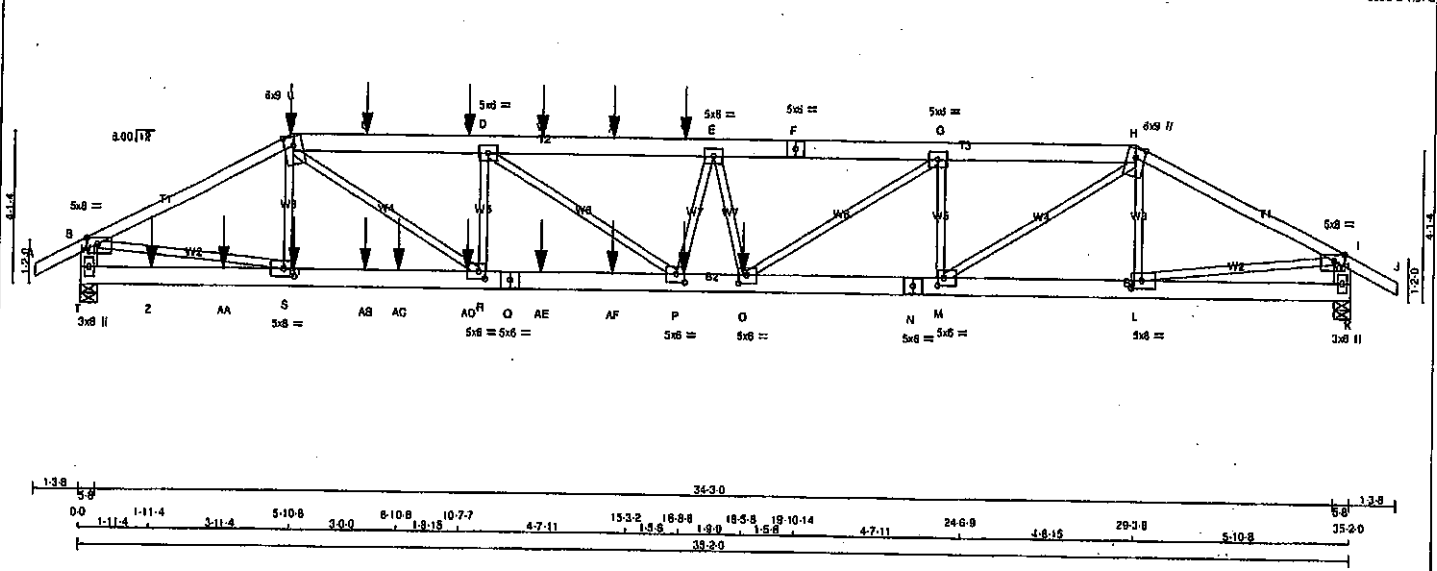

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. A - C 2x4 DRY No.2 C - F 2x6 DRY No.2 F - H 2x6 DRY No.2 H - J 2x4 DRY No.2 T - B 2x6 DRY No.2 K - I 2x6 DRY No.2 T - Q 2x6 DRY No.2 Q - N 2x6 DRY No.2 N - K 2x6 DRY No.2 ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS SURFACE SPACING (IN) LOAD (PLF)

TOP CHORDS : (0.122"x3") SPIRAL NAILS

A-C

1

12

SIDE (61.0)

H-J

1

12

TOP

C-F

2

12

SIDE (61.0)

F-H

2

12

TOP

T-B

2

12

TOP

K-I

2

12

TOP

BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS

T-Q

2

12

SIDE (163.1)

Q-N

2

12

SIDE (0.0)

N-K

2

12

TOP

WEBS : (0.122"x3") SPIRAL NAILS

2x3

1

6

TOP

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

 DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED GROSS REACTION MAXIMUM FACTORED GROSS REACTION INPUT BRG REQD BRG JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX T 4474 0 4474 0 0 5-8 5-8 K 3775 0 3775 0 0 5-8 5-8 UNFACTORED REACTIONS 1ST CASE MAX / MIN COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL T 3162 2088 / 0 0 / 0 0 / 0 0 / 0 1073 / 0 0 / 0 K 2665 1772 / 0 0 / 0 0 / 0 0 / 0 893 / 0 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, K BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.18 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS MAX. FACTORED FORCE (LBS) FACTORED VERT. LOAD (PLF) MAX. CSI (LC) UNBRACED LENGTH WEBS MAX. FACTORED FORCE (LBS) MAX. CSI (LC) FR-TO A-B 0 / 28 -91.8 -91.8 0.07 (1) 10.00 S-C -384 / 25 0.05 (1) B-C -7163 / 0 -91.8 -91.8 0.71 (1) 3.19 C-R 0 / 4867 0.58 (1) C-U -10299 / 0 -91.8 -91.8 0.32 (1) 3.62 R-D -2057 / 0 0.25 (1) U-V -10299 / 0 -91.8 -91.8 0.32 (1) 3.62 O-G 0 / 3811 0.45 (1) V-D -10299 / 0 -91.8 -91.8 0.32 (1) 3.62 M-G -2637 / 0 0.32 (1) D-W -12012 / 0 -91.8 -91.8 0.45 (1) 3.27 L-H -816 / 0 0.08 (1) W-X -12012 / 0 -91.8 -91.8 0.45 (1) 3.27 B-S 0 / 6479 0.80 (1) X-Y -12012 / 0 -91.8 -91.8 0.45 (1) 3.27 L-I 0 / 5333 0.86 (1) Y-E -12012 / 0 -91.8 -91.8 0.45 (1) 3.27 D-P 0 / 2068 0.28 (1) E-F -12381 / 0 -91.8 -91.8 0.40 (1) 3.28 M-H 0 / 4950 0.61 (1) F-G -12381 / 0 -91.8 -91.8 0.40 (1) 3.28 P-E -1110 / 0 0.14 (1) G-H -9388 / 0 -91.8 -91.8 0.25 (1) 3.84 E-O 0 / 383 0.05 (1) H-I -5888 / 0 -91.8 -91.8 0.59 (1) 3.58 I-J 0 / 28 -91.8 -91.8 0.07 (1) 10.00 T-B -4430 / 0 0.0 0.0 0.16 (1) 6.82 K-I -3716 / 0 0.0 0.0 0.13 (1) 7.31 T-Z 0 / 0 -18.5 -18.5 0.08 (4) 10.00 Z-AA 0 / 0 -18.5 -18.5 0.08 (4) 10.00 AA-S 0 / 0 -18.5 -18.5 0.08 (4) 10.00 S-AB 0 / 6432 -18.5 -18.5 0.69 (1) 10.00 AB-AC 0 / 6432 -18.5 -18.5 0.69 (1) 10.00 AC-AD 0 / 6432 -18.5 -18.5 0.69 (1) 10.00 AD-R 0 / 6432 -18.5 -18.5 0.69 (1) 10.00 R-Q 0 / 10298 -18.5 -18.5 0.78 (1) 10.00 Q-AE 0 / 10298 -18.5 -18.5 0.78 (1) 10.00 AE-AF 0 / 10298 -18.5 -18.5 0.78 (1) 10.00 AF-P 0 / 10298 -18.5 -18.5 0.76 (1) 10.00 P-O 0 / 12286 -18.5 -18.5 0.91 (1) 10.00 O-N 0 / 9385 -18.5 -18.5 0.72 (1) 10.00 N-M 0 / 9385 -18.5 -18.5 0.72 (1) 10.00 M-L 0 / 5303 -18.5 -18.5 0.37 (1) 10.00 L-K 0 / 0 -18.5 -18.5 0.04 (4) 10.00 | DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 25.8 PSF DL = 8.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF CBC 2015, CBC 2012, ABC 2019 - PART 9 OF CBC 2012 (2019 AMENDMENT) - CSA 086-09, CSA 086-14 - TPIC 2011, TPIC 2014 (55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL. (LL) = L/360 (1.17") CALCULATED VERT. DEFL. (LL) = L/999 (0.31") ALLOWABLE DEFL. (TL) = L/360 (1.17") CALCULATED VERT. DEFL. (TL) = L/740 (0.57") CSI: TC=0.71/1.00 (B-C:1), BC=0.91/1.00 (O-P:1), WB=0.80/1.00 (B-S:1), SS=0.15/1.00 (R-S:1) DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00 COMPANION LIVE LOAD FACTOR = 1.00 AUTOSOLVE HEELS OFF TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL) MAX MIN MAX MIN MAX MIN MT20 618 354 1887 788 1987 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP = 0.89 (S) (INPUT = 0.90) JSI METAL = 0.93 (N) (INPUT = 1.00) |

Structural component only
DWG# T-2007108



Structural component only
DWG# T-2007108

JOB NAME 408152	TRUSS NAME T40Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 11:29:34 2020 Page 2
ID:7vF?aG0E03cRUj0X18rkziWYK-ydH2MiuB57imK3i1? 4iCnCV?E2GhUJzvKGnGJzNCOV

PLATES (table/s in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMWW-p	MT20	5.0	8.0	2.00 3.50
C	TTWW-m	MT20	6.0	9.0	Edge
D, E, G					
D	TMWW-t	MT20	5.0	6.0	
F	TS-t	MT20	5.0	6.0	
H	TTWW-m	MT20	6.0	9.0	Edge
I	TMWW-p	MT20	5.0	8.0	2.00 3.50
K	BMV1-p	MT20	3.0	6.0	
L	BMWW-t	MT20	5.0	6.0	2.50 3.50
M	BMWW-t	MT20	5.0	6.0	2.50 2.00
N	BS-t	MT20	5.0	6.0	
O	BMWW-t	MT20	5.0	6.0	2.75 2.75
P	BMWW-t	MT20	5.0	6.0	2.75 2.75
Q	BS-t	MT20	5.0	6.0	
R	BMWW-t	MT20	5.0	6.0	2.50 2.00
S	BMWW-t	MT20	5.0	6.0	2.50 3.50
T	BMV1-p	MT20	3.0	6.0	


Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
X	14-9-12	-82	-82	---	BACK	VERT	TOTAL	---	C1
Y	16-9-12	-82	-82	---	BACK	VERT	TOTAL	---	C1
Z	1-11-4	-25	-25	---	BACK	VERT	TOTAL	---	C1
AA	3-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AB	7-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AC	8-10-8	-639	-639	---	BACK	VERT	TOTAL	---	C1
AD	10-8-12	-17	-17	---	BACK	VERT	TOTAL	---	C1
AE	12-9-12	-17	-17	---	BACK	VERT	TOTAL	---	C1
AF	14-9-12	-17	-17	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

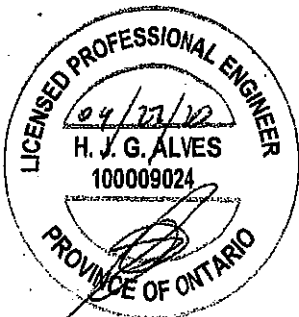


Structural component only
DWG# T-2007108

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408152	T41	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:35 2020 Page 1
ID:7vF7aG0E03cRUj6X1SkrzIWKYK-OpQa2vprQdxDHDYhbxk_kd2aSiQx967_0Np1zNCOU

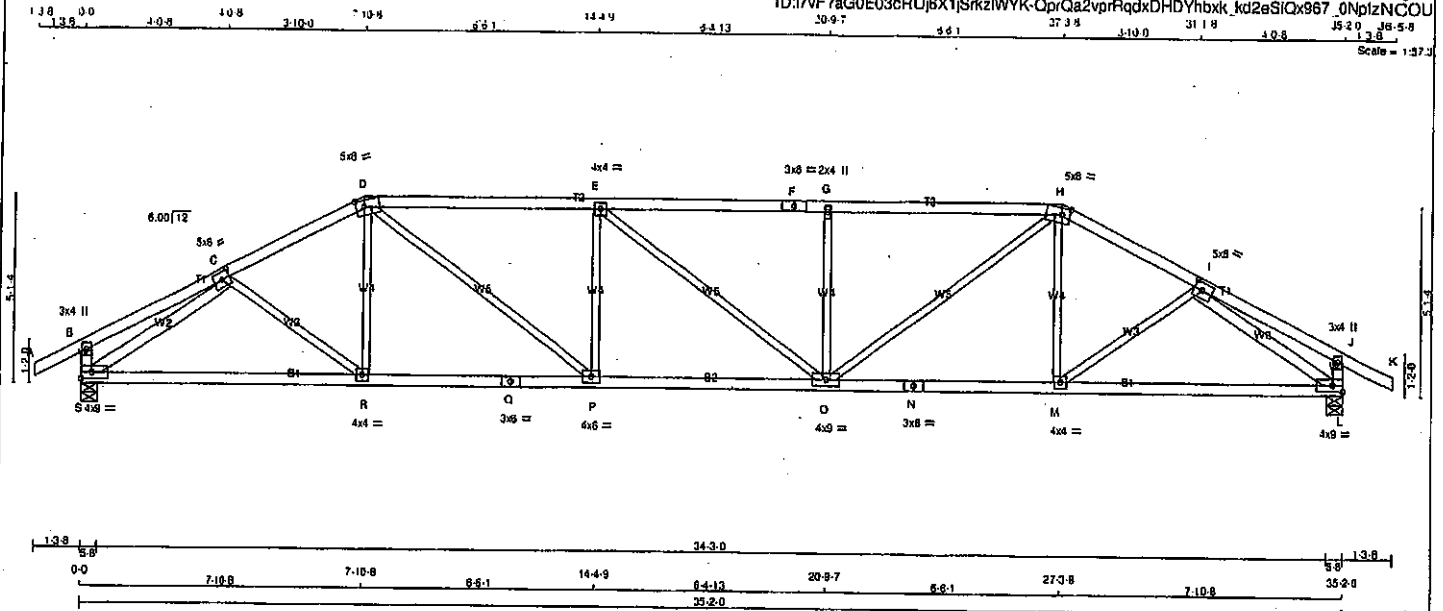

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMV+p	MT20	3.0	4.0	
C TMWW-l	MT20	5.0	8.0	2.50 2.75
D TTWW-m	MT20	5.0	8.0	2.25 2.75
E TMWW-l	MT20	4.0	4.0	
F TS-l	MT20	3.0	8.0	
G TMWW-w	MT20	2.0	4.0	
H TTWW-m	MT20	5.0	8.0	2.25 2.75
I TMWW-l	MT20	5.0	8.0	2.50 2.75
J TMV+p	MT20	3.0	4.0	
L BMWW-l	MT20	4.0	9.0	Edge
M BMWW-l	MT20	4.0	4.0	
N BS-l	MT20	3.0	8.0	
O BMWW-l	MT20	4.0	9.0	
P BMWW-l	MT20	4.0	8.0	
Q BS-l	MT20	3.0	8.0	
R BMWW-l	MT20	4.0	4.0	
S BMWW-l	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	DOWN	UPLIFT	IN-SX
S 2063 0	2063 0	0 0	5-8 5-8
L 2063 0	2063 0	0 0	5-8 5-8

UNFACTORED REACTIONS			
1ST LCASE	MAX/MIN COMPONENT REACTIONS		
JT COMBINED	SNOW	LIVE	PERM.LIVE
S 1457 969 / 0	0 / 0	0 / 0	0 / 0
L 1457 969 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.94 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING			
TOTAL LOAD CASES: (4)			
CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1	MAX. UNBRACED LENGTH
FR-TO			
A-B	0 / 28	-91.8 -91.8 0.12 (1)	10.00
B-C	0 / 16	-91.8 -91.8 0.20 (1)	10.00
C-D	-2799 / 0	-91.8 -91.8 0.32 (1)	3.88
D-E	-3508 / 0	-91.8 -91.8 0.95 (1)	2.94
E-F	-3507 / 0	-91.8 -91.8 0.93 (1)	2.94
F-G	-3507 / 0	-91.8 -91.8 0.94 (1)	2.95
G-H	-2799 / 0	-91.8 -91.8 0.32 (1)	3.88
H-I	0 / 16	-91.8 -91.8 0.20 (1)	10.00
I-J	0 / 28	-91.8 -91.8 0.12 (1)	10.00
J-K	-270 / 0	0.0 0.0 0.03 (1)	7.81
K-L	-270 / 0	0.0 0.0 0.03 (1)	7.81
S-R	0 / 2417	-18.5 -18.5 0.53 (1)	10.00
R-Q	0 / 2489	-18.5 -18.5 0.54 (1)	10.00
Q-P	0 / 2489	-18.5 -18.5 0.54 (1)	10.00
P-O	0 / 3509	-18.5 -18.5 0.64 (1)	10.00
O-N	0 / 2489	-18.5 -18.5 0.54 (1)	10.00
N-M	0 / 2489	-18.5 -18.5 0.54 (1)	10.00
M-L	0 / 2417	-18.5 -18.5 0.53 (1)	10.00

TOTAL WEIGHT = 2 X 139 = 278 lb

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF 8CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = U360 (1.17)
CALCULATED VERT. DEFL.(LL) = 1/989 (0.21)
ALLOWABLE DEFL.(TL) = U360 (1.17)
CALCULATED VERT. DEFL.(TL) = 1/989 (0.41)

CSI: TC=0.95/1.00 (D-E:1), BC=0.84/1.00 (O-P:1), WB=0.83/1.00 (H-I), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HELLS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLU) (PU)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (L) (INPUT = 0.80)
JSI METAL = 0.77 (N) (INPUT = 1.00)

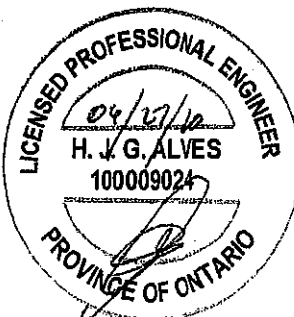

Structural component only
DWG# T-2007109

JOB NAME 408152	TRUSS NAME T42	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 11:29:36 2020 Page 1	
ID: i7vF7aG0E03cRUj8X1S1kzWYK-u?PpnOvRckyUZNSP6P8AHCHnN1r19RDGMwLcZNCOT				Scale = 1/57.3	

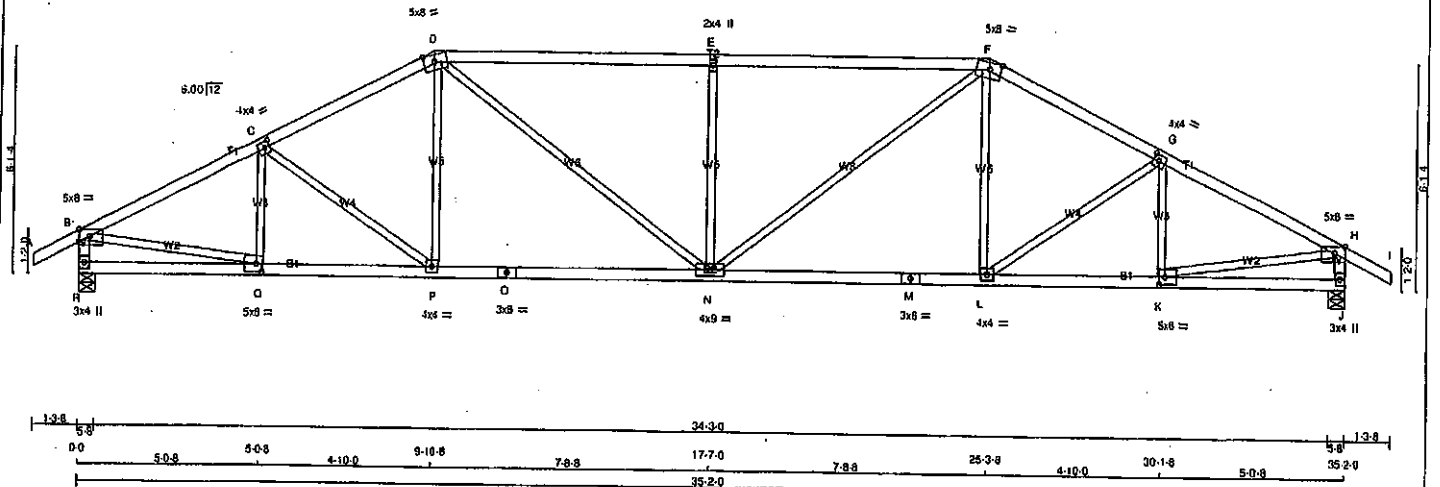

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - I	2x4	DRY No.2	SPF
I - B	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
R - O	2x4	DRY No.2	SPF
O - M	2x4	DRY No.2	SPF
M - J	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (tabula in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMWW-p	MT20	5.0	8.0 Edge 3.50
C	TMWW-l	MT20	4.0	4.0 2.00 1.75
D	TTWW-m	MT20	5.0	8.0 2.25 3.75
E	TMWW-w	MT20	2.0	4.0
F	TTWW-m	MT20	5.0	8.0 2.25 3.75
G	TMWW-l	MT20	4.0	4.0 2.00 1.75
H	TMWW-p	MT20	5.0	8.0 Edge 3.50
J	BMV-l-p	MT20	3.0	4.0
K	BMWW-l	MT20	5.0	8.0 2.50 2.00
L	BMWW-l	MT20	4.0	4.0
M	BS-l	MT20	3.0	8.0
N	BMWW-l	MT20	4.0	9.0
O	BS-l	MT20	3.0	8.0
P	BMWW-l	MT20	4.0	4.0
Q	BMWW-l	MT20	5.0	8.0 2.50 2.00
R	BMV-l-p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING DESIGNER							
BEARINGS							
	FACTORED		MAXIMUM FACTORED		INPUT	REQRD	
	GROSS REACTION		GROSS REACTION		BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
R	2083	0	2083	0	0	5-8	5-8
J	2083	0	2083	0	0	5-8	5-8
UNFACTORED REACTIONS							
	1ST CASE		MAX. MIN. COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1457	989 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
J	1457	989 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.78 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. FACTORED FORCE (LBS)
FR-TO				FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	Q-C	-353 / 0	0.08 (1)
B-C	-2834 / 0	-91.8	-91.8 0.39 (1)	3.81	C-P	210 / 0	0.13 (1)
C-D	-2687 / 0	-91.8	-91.8 0.37 (1)	3.91	P-D	0 / 246	0.08 (4)
D-E	-3060 / 0	-91.8	-91.8 0.97 (1)	2.78	D-N	0 / 844	0.19 (1)
E-F	-3080 / 0	-91.8	-91.8 0.97 (1)	2.78	N-E	-872 / 0	0.51 (1)
F-G	-2687 / 0	-91.8	-91.8 0.37 (1)	3.91	N-F	0 / 844	0.19 (1)
G-H	-2834 / 0	-91.8	-91.8 0.39 (1)	3.81	L-F	0 / 246	0.08 (4)
H-I	0 / 28	-91.8	-91.8 0.12 (1)	10.00	L-G	-210 / 0	0.13 (1)
R-B	-2018 / 0	0.0	0.0 0.20 (1)	5.94	K-G	-353 / 0	0.08 (1)
J-H	-2018 / 0	0.0	0.0 0.20 (1)	5.94	B-Q	0 / 2591	0.58 (1)
R-Q	0 / 0	-18.5	-18.5 0.10 (4)	10.00	K-H	0 / 2591	0.58 (1)
Q-P	0 / 2555	-18.5	-18.5 0.51 (1)	10.00			
P-O	0 / 2386	-18.5	-18.5 0.49 (1)	10.00			
O-N	0 / 2386	-18.5	-18.5 0.49 (1)	10.00			
N-M	0 / 2386	-18.5	-18.5 0.49 (1)	10.00			
M-L	0 / 2386	-18.5	-18.5 0.49 (1)	10.00			
L-K	0 / 2555	-18.5	-18.5 0.51 (1)	10.00			
K-J	0 / 0	-18.5	-18.5 0.10 (4)	10.00			

TOTAL WEIGHT = 2 X 139 = 277 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.17")
ALLOWABLE DEFL.(TL) = L/860 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.34")

CSI: TC=0.97/1.00 (D-E:1), BC=0.51/1.00 (K-L:1), WB=0.58/1.00 (H-K:1), SSI=0.34/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (D) (INPUT = 0.90)
JSI METAL= 0.75 (C) (INPUT = 1.00)

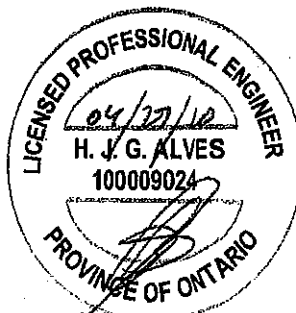


Structural component only
DWG# T-2007110

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408152	T43	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 11:29:37 2020 Page 1

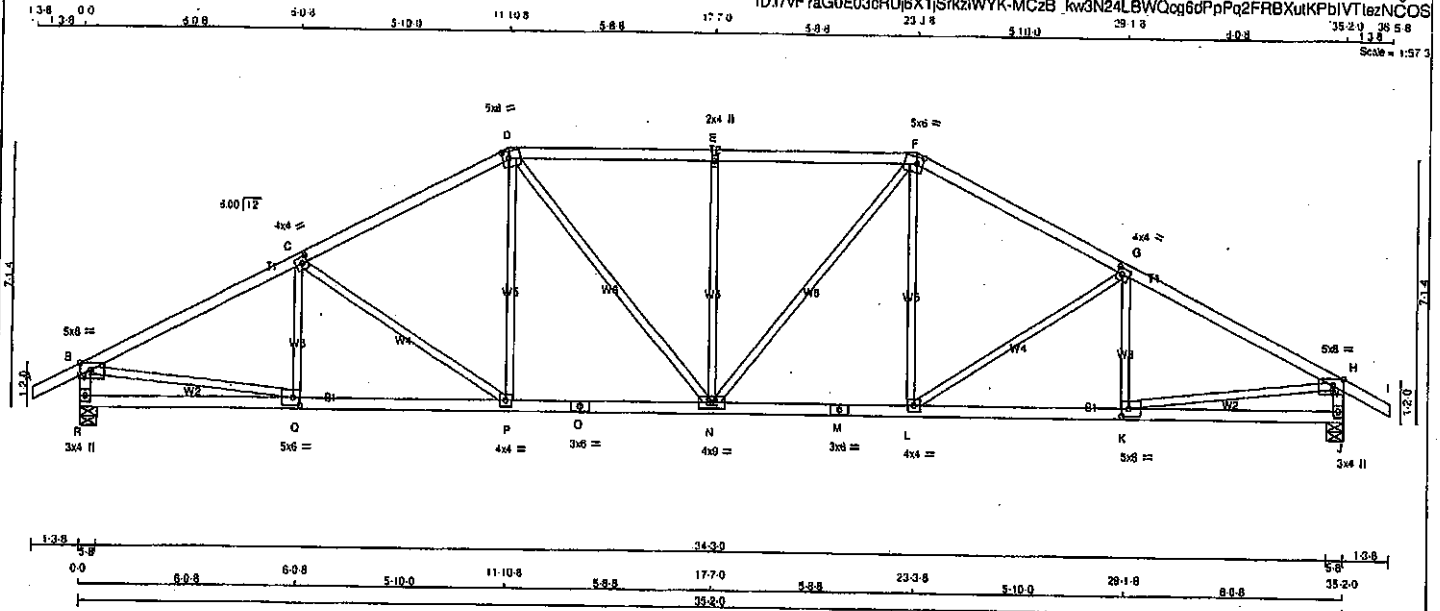

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - B	2x4	DRY	No.2
B - H	2x4	DRY	No.2
H - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW-p	MT20	5.0	8.0 Edge 3.50
C	TMVW-l	MT20	4.0	4.0 2.00 1.75
D	TTWW-m	MT20	5.0	6.0 2.25 2.00
E	TMVW-w	MT20	2.0	4.0
F	TTWW-m	MT20	5.0	6.0 2.25 2.00
G	TMVW-l	MT20	4.0	4.0 2.00 1.75
H	TMVW-p	MT20	5.0	8.0 Edge 3.50
J	BMV1-p	MT20	3.0	4.0
K	BMVW-l	MT20	5.0	6.0 2.50 2.25
L	BMVW-l	MT20	4.0	4.0
M	BS-l	MT20	3.0	8.0
N	BMVW-w	MT20	4.0	9.0
O	BS-l	MT20	3.0	8.0
P	BMVW-l	MT20	4.0	4.0
Q	BMVW-l	MT20	5.0	6.0 2.50 2.25
R	BMV1-p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQ'D BRG
VERT	HORZ	DOWN	HORZ
JT	2063	0	2063
J	2063	0	2063

UNFACTORED REACTIONS			
1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND
JT	COMBINED	SNOW	LIVE
R	1457	969 / 0	0 / 0
J	1457	969 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING			
TOTAL LOAD CASES: (4)			
CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (L)
FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)
B-C	-2889 / 0	-91.8	-91.8 0.58 (1)
C-D	-2539 / 0	-91.8	-91.8 0.52 (1)
D-E	-2559 / 0	-91.8	-91.8 0.48 (1)
E-F	-2559 / 0	-91.8	-91.8 0.48 (1)
F-G	-2539 / 0	-91.8	-91.8 0.52 (1)
G-H	-2589 / 0	-91.8	-91.8 0.58 (1)
H-I	0 / 28	-91.8	-91.8 0.12 (1)
I-B	-2014 / 0	0.0	0.0 0.20 (1)
J-H	-2014 / 0	0.0	0.0 0.20 (1)
R-Q	0 / 0	-18.5	-18.5 0.15 (4)
Q-P	0 / 2609	-18.5	-18.5 0.49 (1)
P-O	0 / 2249	-18.5	-18.5 0.43 (1)
O-N	0 / 2249	-18.5	-18.5 0.43 (1)
N-M	0 / 2249	-18.5	-18.5 0.43 (1)
M-L	0 / 2249	-18.5	-18.5 0.43 (1)
L-K	0 / 2609	-18.5	-18.5 0.49 (1)
K-J	0 / 0	-18.5	-18.5 0.15 (4)

TOTAL WEIGHT = 2 X 145 = 289 lb (M/F)

DESIGN CRITERIA			
SPECIFIED LOADS:			
TOP CH.	LL	=	25.8 PSF
	DL	=	8.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.4 PSF
TOTAL LOAD		=	39.0 PSF
SPACING		=	24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.15")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.28")

CSK TC=0.58/1.00 (G-H:1), BC=0.49/1.00 (K-L:1), WB=0.59/1.00 (B-Q:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MT20	618	354	1887


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (O) (INPUT = 0.90)
JSI METAL = 0.69 (M) (INPUT = 1.00)



Structural component only
DWG# T-2007111

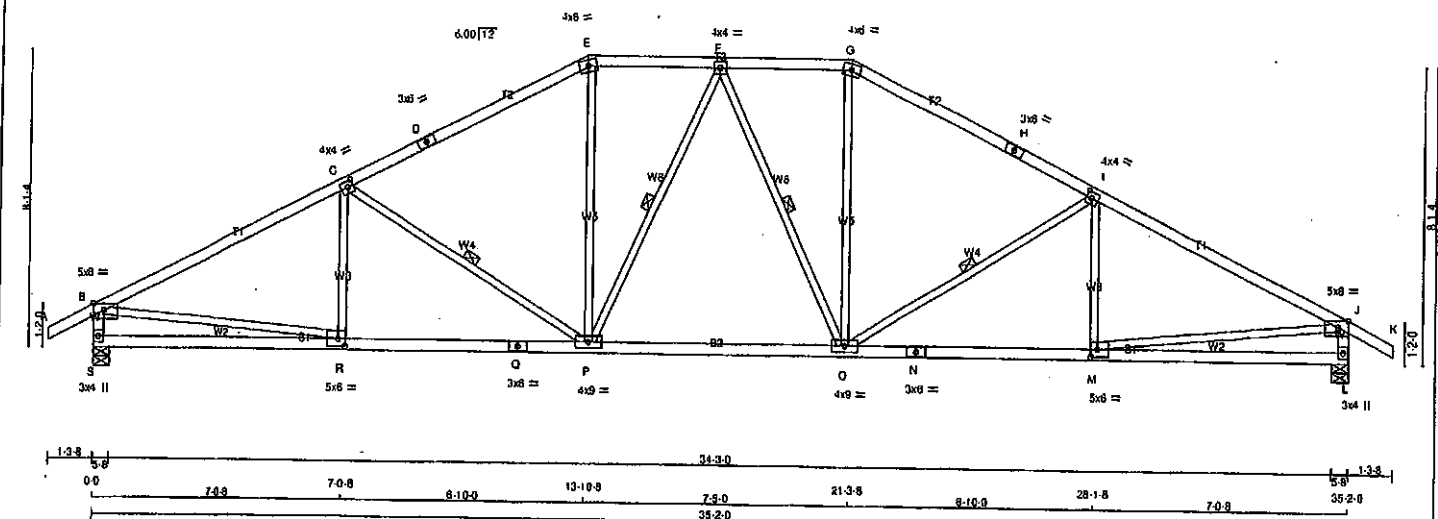

LUMBER			
N. L. G. A.	RULES		
CHORDS	SIZE	LUMBER	DESCR
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
			SPF

DRY: SEASONED LUMBER

PLATES (table in inches)					
J	TYPE	PLATES	W	LEN	Y X
R	TMWV-p	MT20	5.0	8.0	Edge 3.50
C	TMWV-t	MT20	4.0	4.0	2.00 1.75
D	TS-t	MT20	3.0	6.0	
E	TTW-m	MT20	4.0	8.0	
F	TMWV-t	MT20	4.0	4.0	
G	TTW-m	MT20	4.0	8.0	
H	TS-t	MT20	3.0	8.0	
I	TMWV-t	MT20	4.0	4.0	2.00 1.75
J	TMWV-p	MT20	5.0	8.0	Edge 3.50
L	BMV1+p	MT20	3.0	4.0	
M	BMWV-t	MT20	5.0	8.0	2.50 2.25
N	BS-t	MT20	3.0	6.0	
O	BMWVWV-t	MT20	4.0	9.0	
P	BMWVWV-t	MT20	4.0	9.0	
Q	BS-t	MT20	3.0	6.0	
R	BMWV-t	MT20	5.0	6.0	2.50 2.25
S	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
S	2063	0	2063	0	0	5-8	5-8
L	2063	0	2063	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1457	869 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1457	869 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S. L.

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-P, F-P, F-O, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED			
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	LC1 MAX OSI (LC)	MAX. UNBRAC	MEMB.	FORCE (LBS)	MAX OSI (LC)
FR-TO		FROM TO		LENGTH	FR-TO		
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	R-C	-182 / 52
B-C	-2908 / 0	-91.8	-91.8	0.83 (1)	3.25	C-P	-637 / 0
C-D	-2373 / 0	-91.8	-91.8	0.72 (1)	3.66	P-E	0 / 674
D-E	-2373 / 0	-91.8	-91.8	0.72 (1)	3.66	P-F	-222 / 0
E-F	-2100 / 0	-91.8	-91.8	0.19 (1)	4.63	F-O	-222 / 0
F-G	-2100 / 0	-91.8	-91.8	0.19 (1)	4.53	O-G	0 / 674
G-H	-2373 / 0	-91.8	-91.8	0.72 (1)	3.66	O-I	-637 / 0
H-I	-2373 / 0	-91.8	-91.8	0.72 (1)	3.66	I-J	-182 / 52
I-J	-2908 / 0	-91.8	-91.8	0.83 (1)	3.25	B-R	0 / 2649
J-K	0 / 28	-91.8	-91.8	0.12 (1)	10.00	M-J	0 / 2649
S-B	-2008 / 0	0.0	0.0	0.20 (1)	5.96		
L-J	-2008 / 0	0.0	0.0	0.20 (1)	5.96		
S-R	0 / 0	-18.5	-18.5	0.20 (4)	10.00		
R-Q	0 / 2630	-18.5	-18.5	0.52 (1)	10.00		
Q-P	0 / 2630	-18.5	-18.5	0.52 (1)	10.00		
P-O	0 / 2183	-18.5	-18.5	0.45 (1)	10.00		
O-N	0 / 2630	-18.5	-18.5	0.52 (1)	10.00		
N-M	0 / 2630	-18.5	-18.5	0.52 (1)	10.00		
M-L	0 / 0	-18.5	-18.5	0.20 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL =	25.6	PSF
	OL =	8.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD =		39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL)= L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.30")

CSI: TC=0.83/1.00 (I-J:1), BC=0.52/1.00 (M-O:1),
WB=0.80/1.00 (B-R:1), SSI=0.28/1.00 (I-J:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg

JSI GRIP= 0.86 (M) (INPUT = 0.90)
JSI METAL= 0.79 (N) (INPUT = 1.00)




Structural component only
DWG# T-2007112

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	T45	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 11:29:39 2020 Page 1

ID:37vF7aG0E03cRUJ8X1SrkziWYK-Ja5xPQyKvK3Qqa_nXgtwvRdFrwMjnl2c_ayWzNCOQ

Scale = 1/8" = 1'-0"

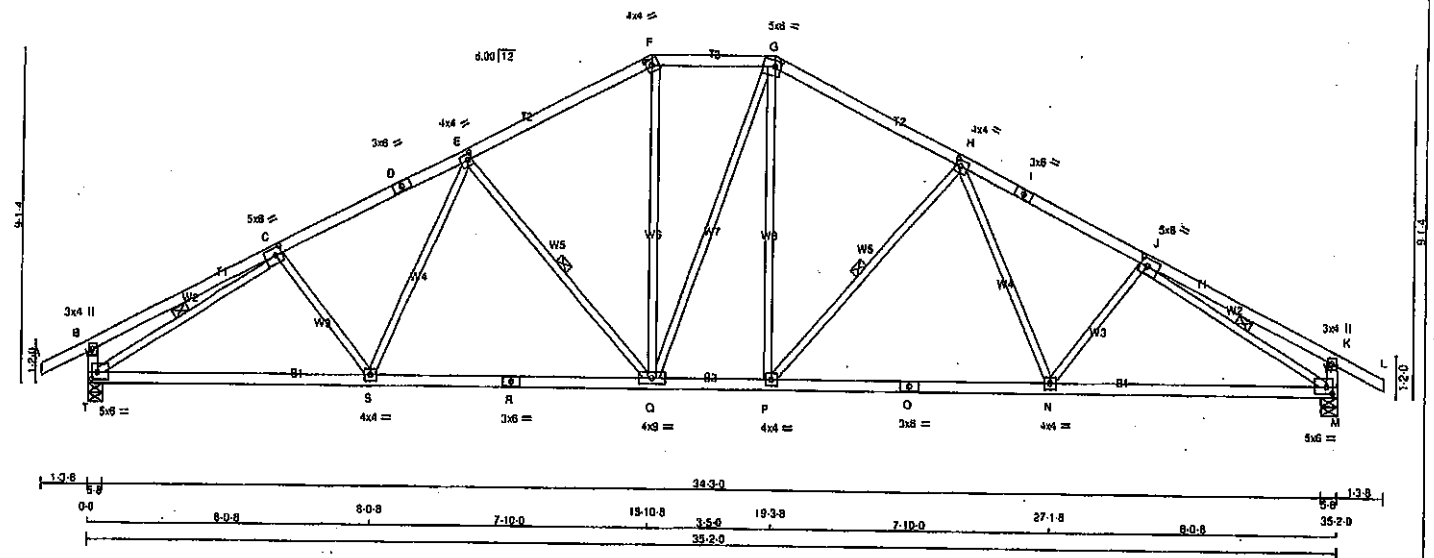

CHORDS	SIZE	LUMBER
A - D	2x4	DRY No.2
D - F	2x4	DRY No.2
F - G	2x4	DRY No.2
G - I	2x4	DRY No.2
I - L	2x4	DRY No.2
L - B	2x4	DRY No.2
B - K	2x4	DRY No.2
K - R	2x4	DRY No.2
R - O	2x4	DRY No.2
O - M	2x4	DRY No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-i	MT20	5.0	6.0	2.50	2.25
D	TS-i	MT20	3.0	6.0		
E	TMWW-i	MT20	4.0	4.0	2.00	1.50
F	TTW-h	MT20	4.0	4.0	2.00	1.75
G	TTWW-m	MT20	5.0	6.0	2.00	2.00
H	TMWW-i	MT20	4.0	4.0	2.00	1.50
I	TS-i	MT20	3.0	6.0		
J	TMWW-i	MT20	5.0	6.0	2.50	2.25
K	TMV+p	MT20	3.0	4.0		
M	BMWW-i	MT20	5.0	6.0	2.25	2.00
N, P, S						
N	BMWW-i	MT20	4.0	4.0		
O	BS-i	MT20	3.0	6.0		
Q	BMWW-i	MT20	4.0	6.0		
R	BS-i	MT20	3.0	6.0		
T	BMWW-i	MT20	5.0	6.0	2.25	2.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	IN-SX	IN-SX
T	2063	0	0	5-8
M	2063	0	0	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERMALIVE	WIND	DEAD	SOIL
T	1457	989 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
M	1457	989 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.88 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-Q, H-P, G-T, J-M

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED	FORCE	VERT.	LOAD	LC1	MAX	MAX.	UNBRAC	WEBS	MEMB.	MAX. FACTORED	FORCE	MAX
			(LBS)		(PLF)		CSI (LC)		LENGTH				(LBS)	CSI (LC)
FR-TO										FR-TO				
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	C-S	-110 / 37	0.04 (1)						
B-C	0 / 19	-91.8	-91.8	0.32 (1)	10.00	S-E	0 / 276	0.06 (1)						
C-D	-2759 / 0	-91.8	-91.8	0.40 (1)	3.88	E-Q	-881 / 0	0.31 (1)						
D-E	-2759 / 0	-91.8	-91.8	0.40 (1)	3.88	Q-F	0 / 613	0.14 (1)						
E-F	-2167 / 0	-91.8	-91.8	0.38 (1)	4.30	Q-G	0 / 4	0.00 (1)						
F-G	-1925 / 0	-91.8	-91.8	0.18 (1)	4.71	P-G	0 / 609	0.14 (1)						
G-H	-2168 / 0	-91.8	-91.8	0.38 (1)	4.30	P-H	-682 / 0	0.31 (1)						
H-I	-2760 / 0	-91.8	-91.8	0.40 (1)	3.88	H-N	0 / 278	0.08 (1)						
I-J	-2760 / 0	-91.8	-91.8	0.40 (1)	3.88	N-J	-110 / 37	0.04 (1)						
J-K	0 / 19	-91.8	-91.8	0.32 (1)	10.00	T-C	-3040 / 0	0.85 (1)						
K-L	0 / 28	-91.8	-91.8	0.12 (1)	10.00	J-M	-3041 / 0	0.85 (1)						
L-B	-326 / 0	0.0	0.0	0.03 (1)	7.81									
M-K	-326 / 0	0.0	0.0	0.03 (1)	7.81									

T-S	0 / 2536	-18.5	-18.5	0.55 (1)	10.00
S-R	0 / 2362	-18.5	-18.5	0.53 (1)	10.00
R-Q	0 / 2362	-18.5	-18.5	0.53 (1)	10.00
Q-P	0 / 1924	-18.5	-18.5	0.40 (1)	10.00
P-O	0 / 2362	-18.5	-18.5	0.53 (1)	10.00
O-N	0 / 2362	-18.5	-18.5	0.53 (1)	10.00
N-M	0 / 2537	-18.5	-18.5	0.56 (1)	10.00

TOTAL WEIGHT = 2 X 151 = 302 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL = 6.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.4	PSF	
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.15")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.32")

CSI: TC=0.40/1.00 (H-J:1), BC=0.56/1.00 (M-N:1), WB=0.83/1.00 (J-M:1), SS=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618	354	1887 789 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.89 (M) (INPUT = 0.90)


JSI METAL= 0.83 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007113

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	T46	6	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 11:29:41 2020 Page 1
ID:7vF7aG0E03cRU6X1jSrkzWYK-FzCiq6zaRHong8kNvyIL_F_md2XrqH7WwTh0PzNCOO
J520 3856
138
Scale = 1/8" = 1'-0"

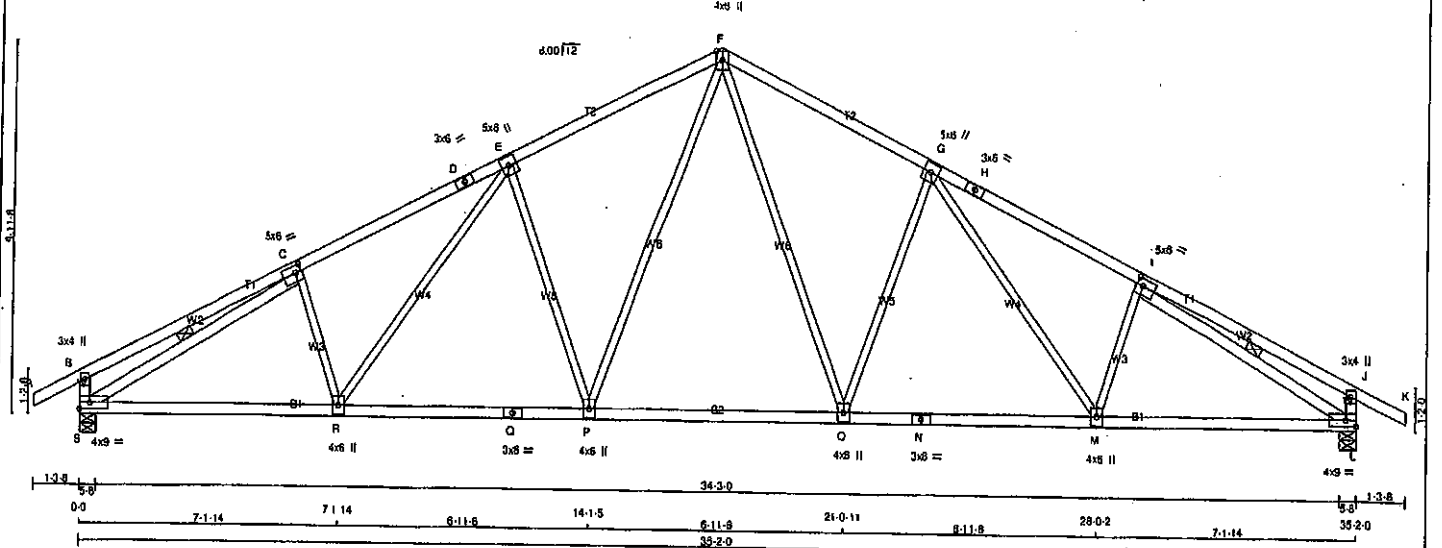

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
EXCEPT			
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+P	MT20	3.0	4.0
C	TMVW-I	MT20	5.0	8.0 2.25 2.00
D	TS-I	MT20	3.0	8.0
E	TMVW+I	MT20	5.0	8.0
F	TTWW+P	MT20	4.0	8.0 Edge
G	TMVW+I	MT20	5.0	8.0
H	TS-I	MT20	3.0	8.0
I	TMVW-I	MT20	5.0	8.0 2.25 2.00
J	TMV+P	MT20	3.0	4.0
L	BMVW-I	MT20	4.0	9.0 Edge
M, O, P, R				
M	BMVW+I	MT20	4.0	8.0
N	BS-I	MT20	3.0	8.0
Q	BS-I	MT20	3.0	8.0
S	BMVW-I	MT20	4.0	9.0 Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQ'D BRG
JT	VERT	DOWN	DOWN	UP	IN-SX
S	2063	0	2063	0	5-8
L	2063	0	2063	0	5-8

UNFACTORED REACTIONS		1ST LCASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE PERM LIVE WIND DEAD SOIL
S	1457	969 / 0	0 / 0 0 / 0 0 / 0 488 / 0 0 / 0
L	1457	969 / 0	0 / 0 0 / 0 0 / 0 488 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-S, I-L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CS1 (LC)	UNBRACED LENGTH	WEBS	MAX. FACTORED MEMB. FORCE (LBS)	MAX CS1 (LC)
FR-TO						FR-TO		
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	F-O	0 / 866	0.19 (1)
B-C	0 / 22	-91.8	-91.8	0.40 (1)	10.00	O-G	-726 / 0	0.72 (1)
C-D	-2808 / 0	-91.8	-91.8	0.49 (1)	3.75	G-M	0 / 391	0.09 (1)
D-E	-2808 / 0	-91.8	-91.8	0.49 (1)	3.75	M-I	-192 / 18	0.05 (1)
E-F	-2322 / 0	-91.8	-91.8	0.46 (1)	4.07	P-F	0 / 866	0.19 (1)
F-G	-2322 / 0	-91.8	-91.8	0.46 (1)	4.07	E-P	-726 / 0	0.72 (1)
G-H	-2808 / 0	-91.8	-91.8	0.49 (1)	3.75	R-E	0 / 391	0.09 (1)
H-I	-2808 / 0	-91.8	-91.8	0.49 (1)	3.75	C-R	-192 / 18	0.05 (1)
I-J	0 / 22	-91.8	-91.8	0.40 (1)	10.00	S-C	-3064 / 0	0.72 (1)
J-K	0 / 28	-91.8	-91.8	0.12 (1)	10.00	I-L	-3064 / 0	0.72 (1)
S-B	-344 / 0	0.0	0.0	0.03 (1)	7.81			
L-J	-344 / 0	0.0	0.0	0.03 (1)	7.81			
S-R	0 / 2574	-18.5	-18.5	0.53 (1)	10.00			
R-O	0 / 2291	-18.5	-18.5	0.47 (1)	10.00			
Q-P	0 / 2291	-18.5	-18.5	0.47 (1)	10.00			
P-O	0 / 1762	-18.5	-18.5	0.38 (1)	10.00			
O-N	0 / 2291	-18.5	-18.5	0.47 (1)	10.00			
N-M	0 / 2291	-18.5	-18.5	0.47 (1)	10.00			
M-L	0 / 2574	-18.5	-18.5	0.53 (1)	10.00			

TOTAL WEIGHT = 6 X 152 = 910 lb [M/F]

DESIGN CRITERIA

SPECIFIED LOADS:
TOP - CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2010
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.17")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.14")
ALLOWABLE DEFL.(TL) = $L/360$ (1.17")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.28")

CS1: TC=0.49/1.00 (C-E:1), BC=0.53/1.00 (L-M:1), WB=0.72/1.00 (E-P:1), SS=0.22/1.00 (K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSD) (PLI) (PLI)
MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (C) (INPUT = 0.80)
JSI METAL= 0.77 (I) (INPUT = 1.00)

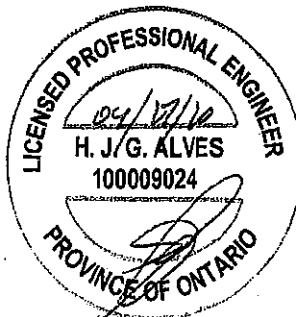

Structural component only
DWG# T-2007114

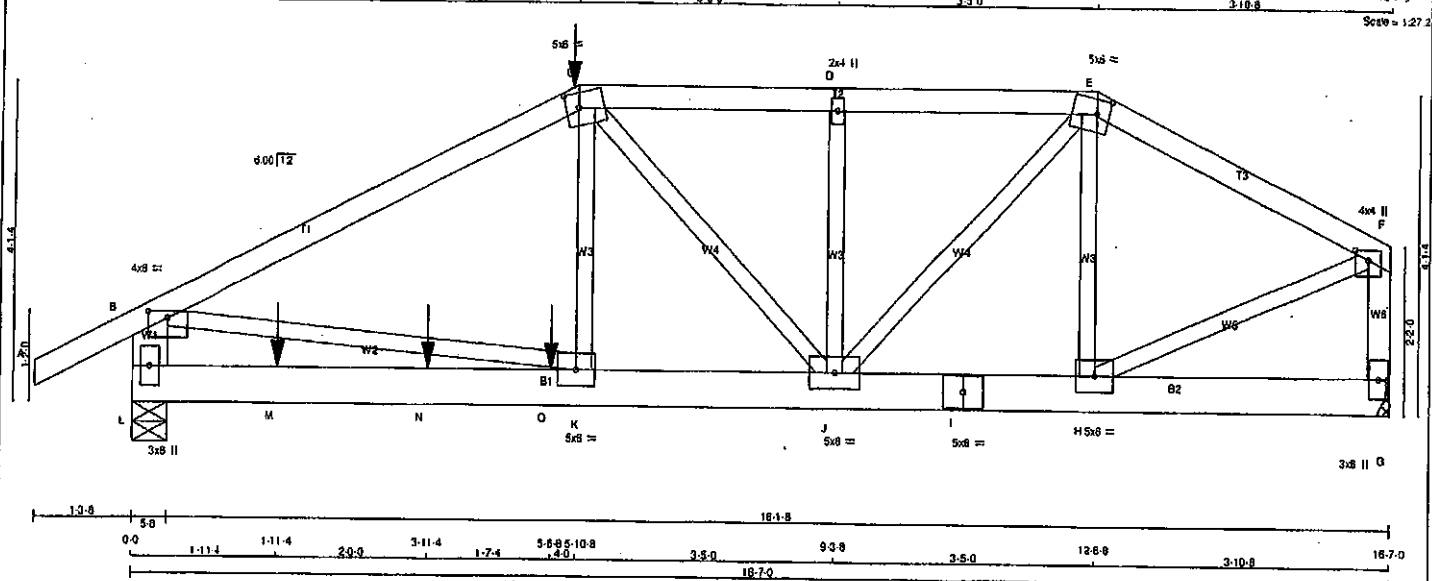

CHORDS	SIZE	SPACING (IN)	LOAD (PLF)
A-C	2x4	12	12
C-E	2x4	12	12
E-F	2x4	12	12
F-G	2x4	12	12
G-H	2x4	12	12
H-I	2x4	12	12
I-J	2x4	12	12
J-K	2x4	12	12
K-L	2x4	12	12
L-M	2x4	12	12
M-N	2x4	12	12
N-O	2x4	12	12
O-P	2x4	12	12
P-Q	2x4	12	12
Q-R	2x4	12	12
R-S	2x4	12	12
S-T	2x4	12	12
T-U	2x4	12	12
U-V	2x4	12	12
V-W	2x4	12	12
W-X	2x4	12	12
X-Y	2x4	12	12
Y-Z	2x4	12	12
Z-AA	2x4	12	12

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS	ROWS	SURFACE	LOAD (PLF)
A-C	1	12	12
C-E	1	12	12
E-F	1	12	12
F-G	1	12	12
G-H	1	12	12
H-I	1	12	12
I-J	1	12	12
J-K	1	12	12
K-L	1	12	12
L-M	1	12	12
M-N	1	12	12
N-O	1	12	12
O-P	1	12	12
P-Q	1	12	12
Q-R	1	12	12
R-S	1	12	12
S-T	1	12	12
T-U	1	12	12
U-V	1	12	12
V-W	1	12	12
W-X	1	12	12
X-Y	1	12	12
Y-Z	1	12	12
Z-AA	1	12	12

TOP COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

FACTORED REACTIONS

JT	VERT	HORIZ	DOWN	UP	IN-SX	OUT-SX
JT	2005	0	2005	0	5-8	5-8
G	1397	0	1397	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 2-0.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM	LIVE	WIND	DEAD	SOIL
L	1412	958 / 0	0 / 0	0 / 0	0 / 0	0 / 0	457 / 0	0 / 0
G	985	662 / 0	0 / 0	0 / 0	0 / 0	0 / 0	323 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.18 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	FR-TO	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED HORIZ. LOAD (LBS)	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED HORIZ. LOAD (LBS)
A-B	0 / 28	-91.8	-91.8	0.07 (1)	10.00	0.12 (1)	0.13 (1)
B-C	-2643 / 0	-91.8	-91.8	0.37 (1)	5.18	0.13 (1)	0.05 (1)
C-D	-1951 / 0	-91.8	-91.8	0.10 (1)	6.17	0.13 (1)	0.08 (1)
D-E	-1951 / 0	-91.8	-91.8	0.10 (1)	6.17	0.13 (1)	0.08 (1)
E-F	-1408 / 0	-91.8	-91.8	0.14 (1)	8.25	0.13 (1)	0.08 (1)
F-G	-1885 / 0	0.0	0.0	0.07 (1)	7.81	0.29 (1)	0.17 (1)
G-H	-1389 / 0	0.0	0.0	0.08 (1)	7.81	0.17 (1)	
L-M	0 / 0	-18.5	-18.5	0.10 (1)	10.00		
M-N	0 / 0	-18.5	-18.5	0.10 (1)	10.00		
N-O	0 / 0	-18.5	-18.5	0.10 (1)	10.00		
O-K	0 / 0	-18.5	-18.5	0.10 (1)	10.00		
K-J	0 / 2389	-18.5	-18.5	0.24 (1)	10.00		
J-I	0 / 1243	-18.5	-18.5	0.11 (1)	10.00		
I-H	0 / 1243	-18.5	-18.5	0.11 (1)	10.00		
H-G	0 / 0	-18.5	-18.5	0.02 (4)	10.00		

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-320	-320	---	FRONT	VERT	TOTAL	CI
M	1-11-4	-25	-25	---	FRONT	VERT	TOTAL	CI
N	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	CI
O	5-6-8	-1076	-1076	---	FRONT	VERT	TOTAL	CI

CONNECTION REQUIREMENTS

1) CI: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
BOT CH. LL = 0.0 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.55")
CALCULATED VERT. DEFL. (LL) = L/999 (0.03")
ALLOWABLE DEFL. (TL) = L/360 (0.55")
CALCULATED VERT. DEFL. (TL) = L/999 (0.06")

CSI: TC=0.37/1.00 (B-C:1), BC=0.24/1.00 (J-K:1), WB=0.29/1.00 (B-K:1), SSI=0.37/1.00 (K-L:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

PLATE	GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	788	1987	1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.80 (B) (INPUT = 0.90)
JSI METAL = 0.32 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007115

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	T47	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 11:29:42 2020 Page 2
ID:37vF?aG0E03cRU8X1ISrkzWYK-j9m42R CCAieHlJZTIDaWTXzGSyYZDD8kZDEYzNCON


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	6.0	1.00	3.00
C	TTWW-m	MT20	5.0	6.0	2.25	2.00
D	TMVW-w	MT20	2.0	4.0		
E	TTWW-m	MT20	5.0	6.0	2.25	2.00
F	TMVW-p	MT20	4.0	4.0	1.50	2.00
G	BMVl+p	MT20	3.0	6.0		
H	BMWW-t	MT20	5.0	6.0		
I	BS-t	MT20	5.0	6.0		
J	BMWWW-l	MT20	5.0	8.0		
K	BMWW-t	MT20	5.0	6.0		
L	BMVl+p	MT20	3.0	6.0		

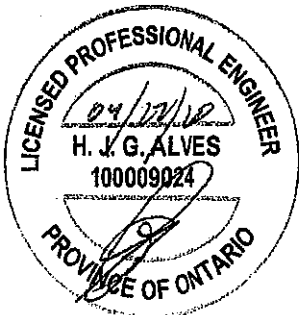

Structural component only
DWG# T-2007115

JOB NAME 408152	TRUSS NAME T48	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

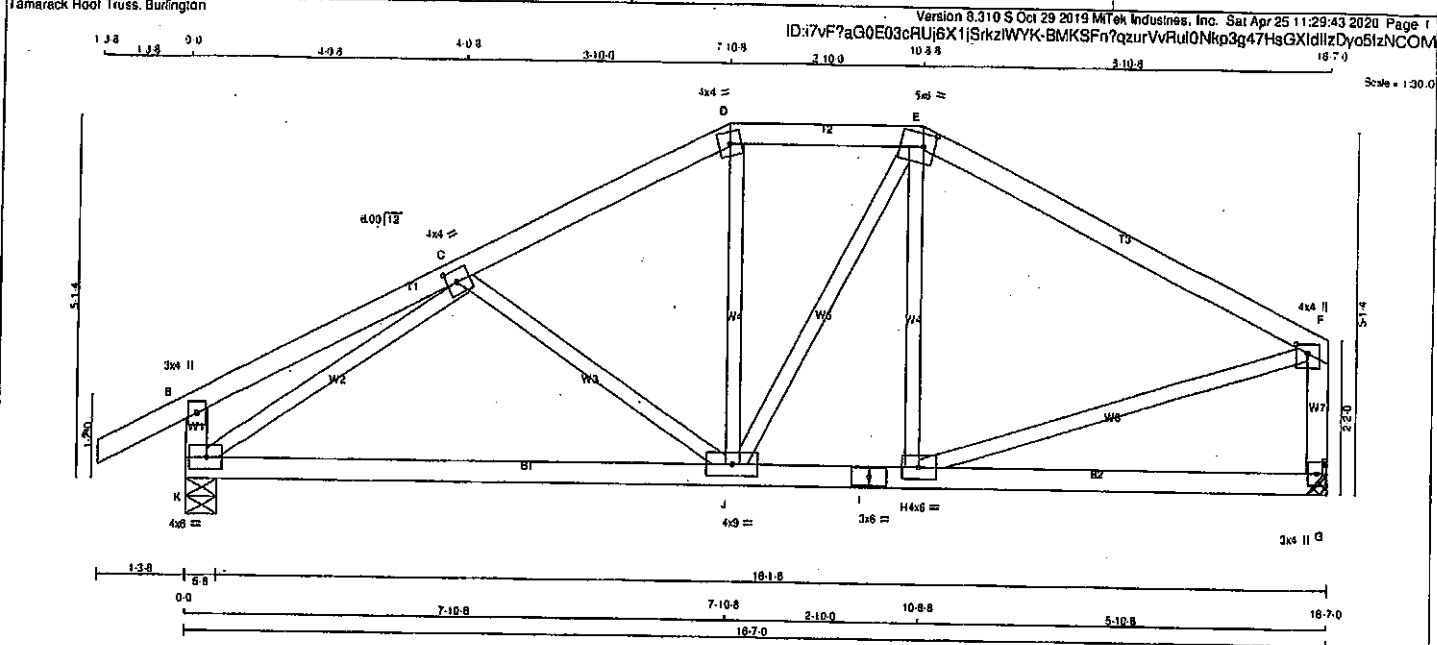

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - E	2x4	DRY No.2	SPF
E - F	2x4	DRY No.2	SPF
K - B	2x4	DRY No.2	SPF
G - F	2x4	DRY No.2	SPF
K - I	2x4	DRY No.2	SPF
I - G	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

ORY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-1	MT20	4.0	4.0	2.00	1.75
D	TTW-m	MT20	4.0	4.0		
E	TTW-m	MT20	5.0	8.0	2.25	2.00
F	TMVW+p	MT20	4.0	4.0	1.50	2.00
G	BMV1+p	MT20	3.0	4.0		
H	BMVW-1	MT20	4.0	6.0		
I	BS-1	MT20	3.0	6.0		
J	BMVW-1	MT20	4.0	9.0		
K	BMVW-1	MT20	4.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	HORZ	DOWN	HORZ
K 1039	0	1039	0
G 914	0	914	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

1ST CASE	MAX/MIN	COMPONENT REACTIONS
JT COMBINED	SNOW	LIVE
K 732	494 / 0	0 / 0
G 846	424 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.12 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	C-J	-232 / 0	0.10 (1)
B-C	0 / 19	-91.8	-91.8 0.22 (1)	10.00	J-D	0 / 134	0.03 (4)
C-D	-918 / 0	-91.8	-91.8 0.18 (1)	8.24	J-E	0 / 152	0.03 (1)
D-E	-808 / 0	-91.8	-91.8 0.10 (1)	8.25	H-E	-183 / 0	0.06 (1)
E-F	-821 / 0	-91.8	-91.8 0.42 (1)	8.12	K-C	-1221 / 0	0.47 (1)
K-B	-285 / 0	0.0	0.0 0.03 (1)	7.81	H-F	0 / 789	0.17 (1)
G-F	-866 / 0	0.0	0.0 0.10 (1)	7.81			
K-J	0 / 993	-18.5	-18.5 0.32 (4)	10.00			
J-I	0 / 731	-18.5	-18.5 0.31 (4)	10.00			
I-H	0 / 731	-18.5	-18.5 0.31 (4)	10.00			
H-G	0 / 0	-18.5	-18.5 0.15 (4)	10.00			

TOTAL WEIGHT = 68 lb (M)

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPOC 2011, TPOC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.55")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.55")
CALCULATED VERT. DEFL.(TL) = L/999 (0.13")

CSI: TC=0.42/1.00 (E-F:1), BC=0.32/1.00 (J-K:4), WB=0.47/1.00 (C-K:1), SS=0.19/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(ORY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1687 786 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (C) (INPUT = 0.90)
JSI METAL= 0.41 (C) (INPUT = 1.00)

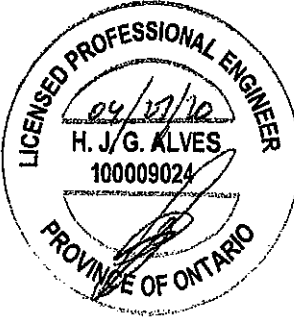

Structural component only
DWG# T-2007116

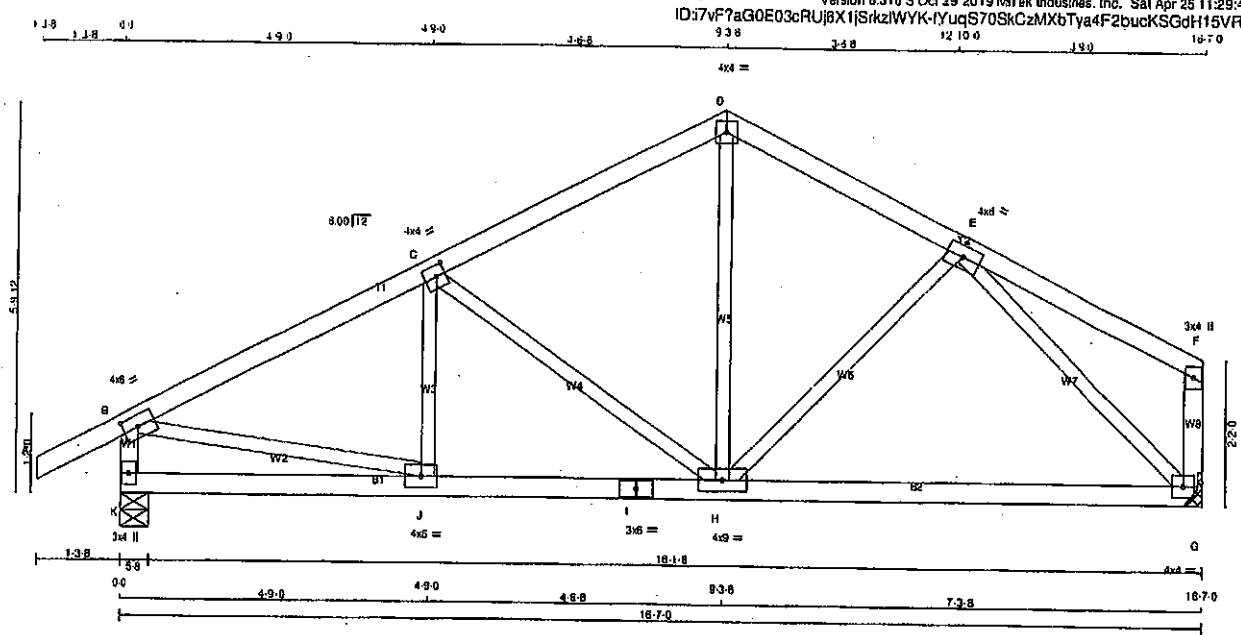

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
K - B	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF
I - G	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	6.0	2.00	3.00
C	TMVW-1	MT20	4.0	4.0	2.00	1.75
D	TTW-p	MT20	4.0	4.0		
E	TMVW-1	MT20	4.0	6.0		
F	TMV-p	MT20	3.0	4.0		
G	BMVW-1	MT20	4.0	4.0		
H	BMVW-1	MT20	4.0	9.0		
I	BS-1	MT20	3.0	6.0		
J	BMVW-1	MT20	4.0	8.0		
K	BMV-1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	UPLIFT
K	1039	0	1039	0
G	914	0	914	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST LOASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
K	732	494 / 0	0 / 0	0 / 0	236 / 0	0 / 0
G	646	424 / 0	0 / 0	0 / 0	222 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.66 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 28	-91.8 -91.8	0.12 (1)	J-C	-114 / 23	0.02 (1)	
B-C	-1135 / 0	-91.8 -91.8	0.26 (1)	C-H	-418 / 0	0.22 (1)	
C-D	-799 / 0	-91.8 -91.8	0.25 (1)	H-D	0 / 407	0.09 (1)	
D-E	-793 / 0	-91.8 -91.8	0.15 (1)	H-E	-39 / 37	0.02 (1)	
E-F	0 / 17	-91.8 -91.8	0.19 (1)	B-J	0 / 1051	0.24 (1)	
K-B	-968 / 0	0.0 0.0	0.10 (1)	E-G	-1026 / 0	0.44 (1)	
G-F	-129 / 0	0.0 0.0	0.02 (1)				
K-J	0 / 0	-18.5 -18.5	0.10 (4)				
J-I	0 / 1034	-18.5 -18.5	0.29 (4)				
I-H	0 / 1034	-18.5 -18.5	0.29 (4)				
H-G	0 / 722	-18.5 -18.5	0.26 (4)				

TOTAL WEIGHT = 67 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(56 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.55")
CALCULATED VERT. DEFL. (LL) = L/999 (0.03")
ALLOWABLE DEFL. (TL) = L/360 (0.55")
CALCULATED VERT. DEFL. (TL) = L/999 (0.10")

CSI: TC=0.28/1.00 (B-C:1), BC=0.29/1.00 (H-J:4), WB=0.44/1.00 (E-G:1), SS=0.19/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1937 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.84 (G) (INPUT = 0.90)
JSI METAL = 0.36 (I) (INPUT = 1.00)

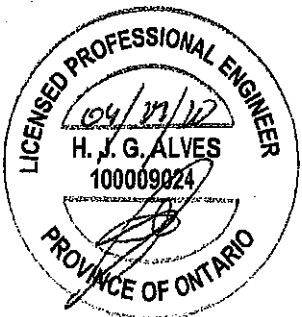

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL =	25.8 PSF
DL =	8.0 PSF
BOY CH. LL =	0.0 PSF
DL =	7.4 PSF
TOTAL LOAD =	39.0 PSF

SPACING = 24.0 IN.C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BC8C 2018 , OBC 2012 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.36")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.01")
ALLOWABLE DEFL.(TL) = $L/380$ (0.36")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.03")

CSI: TC=0.50/1.00 (C-D:1), BC=0.18/1.00 (H-I:1),
WB=0.18/1.00 (E-H:1), SSI=0.21/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES				
PLATE	GRIP (DRY) (PSI)		SHEAR (PLI)	SECTION (PLI)
	MAX	MIN	MAX	MIN
MT20	818	354	1667	788
			1987	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.77 (E) (INPUT = 0.90)
JSI METAL = 0.28 (E) (INPUT = 1.00)

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

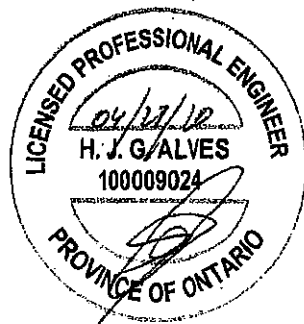


Structural component only
DWG# T-2007118

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408152	T51	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 26 11:29:48 2020 Page 1
ID:7vF7aG0E03cRUj6X1jSkzWYK-cw0btp1jGpD3mvgK1V1WjJg3K9V4Mk1BBShczNCOJ

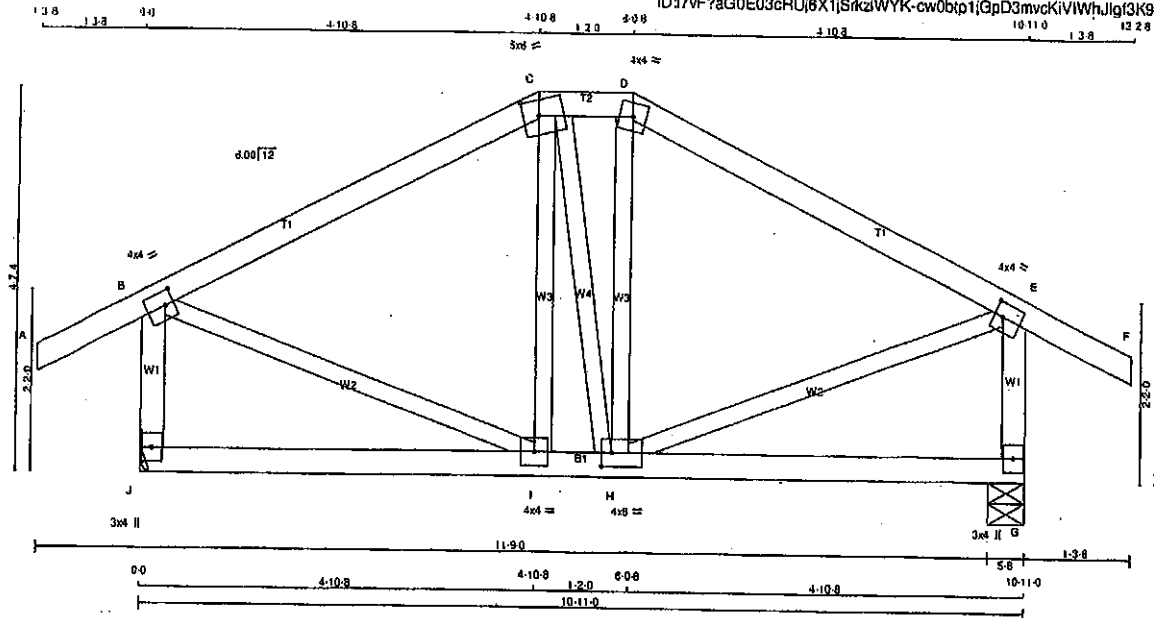

Scale = 1/2\"/>

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2		
C - D	2x4	DRY	No.2		
D - F	2x4	DRY	No.2		
F - G	2x4	DRY	No.2		
G - E	2x4	DRY	No.2		
J - G	2x4	DRY	No.2		

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B TMW-t	MT20	4.0	4.0	2.00	1.25	
C TTW-m	MT20	5.0	6.0	2.25	2.25	
D TTW-m	MT20	4.0	4.0			
E TMW-t	MT20	4.0	4.0	2.00	1.25	
G BMV-t-p	MT20	3.0	4.0			
H BMW-t	MT20	4.0	6.0	2.00	1.50	
I BMW-t	MT20	4.0	4.0			
J BMV-t-p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UP
J	726	0	726	0
G	726	0	726	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 1-8.

UNFACTORED REACTIONS

1ST CASE	MAX./MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	511	349/0	0/0	0/0	0/0	163/0	0/0
G	511	349/0	0/0	0/0	0/0	163/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED	FORCE	VERT. LOAD	LC1	MAX	MAX. UNBRACED LENGTH	FR-TO	WEBS	MEMB.	MAX. FACTORED	FORCE	MAX	MAX. UNBRACED LENGTH	FR-TO
A-B		0/28	-91.8	-91.8	0.12	(1)	10.00	I-C			-78/18	-78/18	0.02	(1)	
B-C		-435/0	-91.8	-91.8	0.28	(1)	8.25	C-H			-4/0	-4/0	0.00	(1)	
C-D		-388/0	-91.8	-91.8	0.02	(1)	8.25	H-D			-82/19	-82/19	0.03	(1)	
D-E		-434/0	-91.8	-91.8	0.28	(1)	8.25	B-I			0/415	0/415	0.09	(1)	
E-F		0/28	-91.8	-91.8	0.12	(1)	10.00	H-E			0/414	0/414	0.09	(1)	
J-B		-688/0	0.0	0.0	0.08	(1)	7.81								
G-E		-688/0	0.0	0.0	0.08	(1)	7.81								
J-I		0/0	-18.5	-18.5	0.10	(4)	10.00								
I-H		0/387	-18.5	-18.5	0.14	(4)	10.00								
H-G		0/0	-18.5	-18.5	0.10	(4)	10.00								

TOTAL WEIGHT = 52 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
ROT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

(56 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.36")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.36")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.28/1.00 (B-C:1), BC=0.14/1.00 (H-I:4), WB=0.09/1.00 (B-I:1), SSI=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

MAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1997 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.66 (B) (INPUT = 0.80)
JSI METAL = 0.22 (B) (INPUT = 1.00)

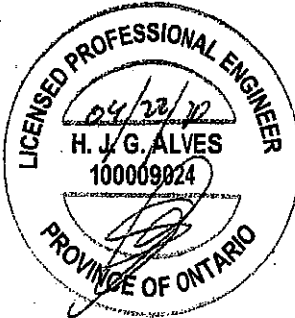

Structural component only
DWG# T-2007119

JOB NAME 408152	TRUSS NAME T52	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 11:29:47 2020 Page 1
ID:17vF7aG0E03cRUj6X1jSkziWYK-47az592L17LwO3BXFDpIDWEEm8TgSEVLturw7E3zNCO

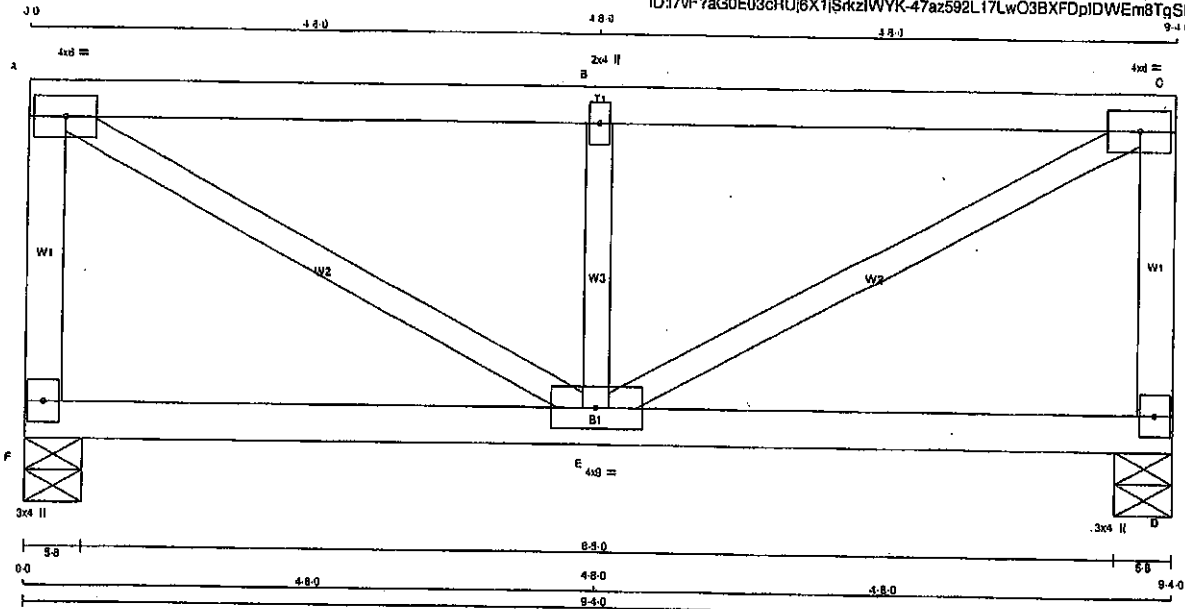

TOTAL WEIGHT = 36 lb (M/R)

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	
F - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS 2x3 DRY			
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
F	620	0	820	0	5-8	5-8
D	620	0	820	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
F	448	239 / 0	0 / 0	0 / 0	0 / 0	209 / 0	0 / 0
D	448	239 / 0	0 / 0	0 / 0	0 / 0	209 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.52 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO		FR-TO
F-A	-583 / 0	0.0 0.0 0.11 (1)	7.81	A-E 0 / 792
A-B	-695 / 0	-114.3 -114.3 0.55 (1)	5.52	E-B -858 / 0
B-C	-695 / 0	-114.3 -114.3 0.55 (1)	5.52	E-C 0 / 792
D-C	-583 / 0	0.0 0.0 0.11 (1)	7.81	
F-E	0 / 0	-18.5 -18.5 0.13 (4)	10.00	
E-D	0 / 0	-18.5 -18.5 0.13 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 15.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 48.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.31")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.31")
CALCULATED VERT. DEFL. (TL) = L/899 (0.03")

CSI: TO=0.55/1.00 (B-C:1), BC=0.13/1.00 (E-F:4), WB=0.24/1.00 (A-E:1), SSI=0.34/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.61 (A) (INPUT = 0.90)
JSI METAL=0.24 (A) (INPUT = 1.00)

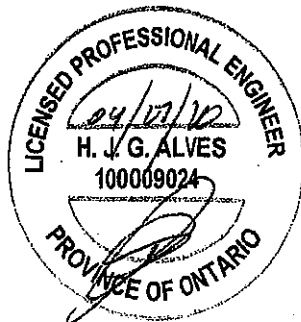

Structural component only
DWG# T-2007120

JOB NAME 408152	TRUSS NAME G52	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 11:29:28 2020 Page 1			
		ID:7vF?aG0E03cRUj6X1SrkzIWK-7Twn6ipQVHydc8EiejlyWyePpDiHyU4WOpV3IzNGOb			

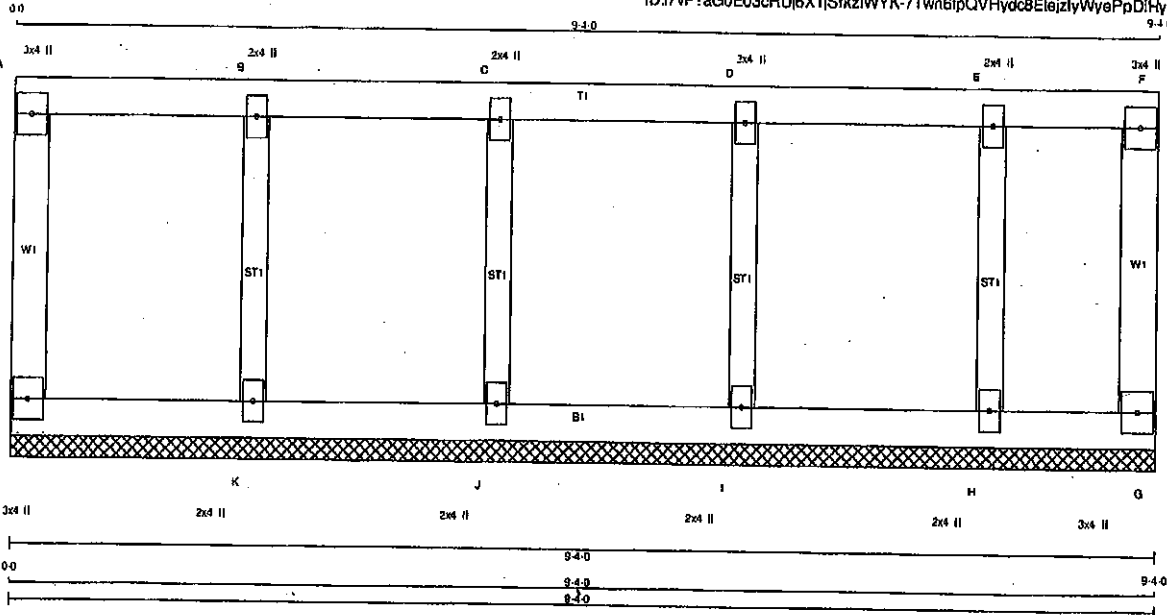

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
L - A	2x4	DRY	No.2
A - F	2x4	DRY	No.2
G - F	2x4	DRY	No.2
L - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			
GABLE STUDS SPACED AT 2'-0" O.C.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMV+p	MT20	3.0	4.0	
B, C, D, E					
B	TMV+w	MT20	2.0	4.0	
F	TMV+p	MT20	3.0	4.0	
G	BMV1+p	MT20	3.0	4.0	
H, I, J, K					
H	BMV1+w	MT20	2.0	4.0	
L	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER
PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING.
BEARINGS
 THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
 THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)
BRACING
 TOP CHORD TO BE SHEATHED OR MAX. FURLIN SPACING = 10.00 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
 ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM TO		FR-TO			
L-A	-101/0	0.0 0.0 0.03 (1)	7.81	K-B	-245/0	0.06 (1)	
A-B	-8/0	-114.3 -114.3 0.08 (1)	10.00	J-C	-224/0	0.05 (1)	
B-C	-8/0	-114.3 -114.3 0.08 (1)	10.00	I-D	-237/0	0.05 (1)	
C-D	-8/0	-114.3 -114.3 0.07 (1)	10.00	H-E	-198/0	0.04 (1)	
D-E	-8/0	-114.3 -114.3 0.07 (1)	10.00				
E-F	-8/0	-114.3 -114.3 0.05 (1)	10.00				
G-F	-84/0	0.0 0.0 0.02 (1)	7.81				
L-K	0/8	-18.5 -18.5 0.02 (4)	10.00				
K-J	0/8	-18.5 -18.5 0.02 (4)	10.00				
J-I	0/8	-18.5 -18.5 0.02 (4)	10.00				
I-H	0/8	-18.5 -18.5 0.02 (4)	10.00				
H-G	0/8	-18.5 -18.5 0.02 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 15.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 48.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.08/1.00 (A-B:1), BC=0.02/1.00 (K-L:4), WB=0.08/1.00 (B-K:1), SS=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

**COMPANION LIVE LOAD FACTOR = 1.00
 FLAT ROOF FACTOR = 0.75**

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

**JSI GRIP= 0.17 (K) (INPUT = 0.90)
 JSI METAL= 0.07 (K) (INPUT = 1.00)**




Structural component only
 DWG# T-2007104

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408152	T53	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mike Industries, Inc. Sat Apr 25 11:29:48 2020 Page 1
ID: i7vF?ag0E03cRU6X1SrkzIWK-VJ7LIV3zoQTn?DmipwK_mkn0tt?2zwn17VgZmVzNCOH

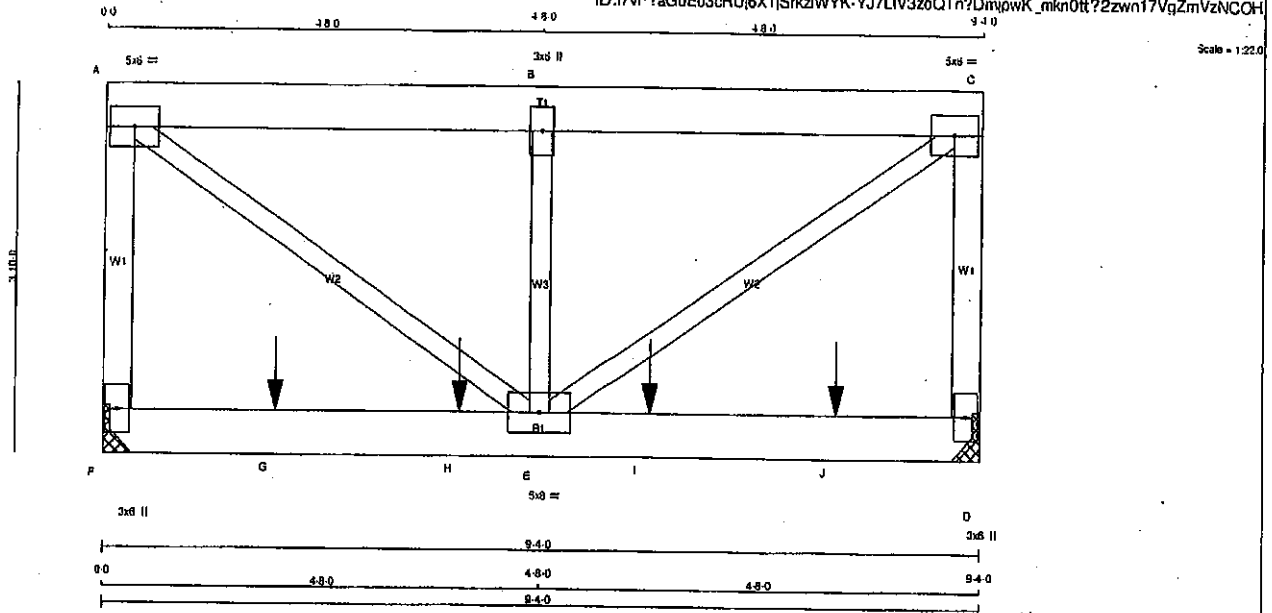

LUMBER				LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DRY	No.2	DESCR.	SPF	SPF
F - A	2x4	DRY	No.2				
A - C	2x6	DRY	No.2				
C - C	2x4	DRY	No.2				
F - D	2x6	DRY	No.2				
ALL WEBS 2x3 DRY				No.2			
DRY: SEASONED LUMBER.							

PLATES (tables in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
A	TMW-I	MT20	5.0	6.0		
B	TMW-w	MT20	3.0	6.0		
C	TMW-I	MT20	5.0	6.0		
D	BMV-I-p	MT20	3.0	6.0		
E	BMWW-I	MT20	5.0	6.0		
F	BMV-I-p	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER
PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING.

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
F	988	0	988	0	0
D	1012	0	1012	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F, D. MINIMUM BEARING LENGTH AT JOINT F = 3-8, JOINT D = 3-8.

UNFACTORED REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	705	427/0	0/0	0/0	0/0	279/0	0/0
D	722	439/0	0/0	0/0	0/0	283/0	0/0

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	MAX.	MEMB.	MAX. FACTORED	FACTORED	MAX.
FR-TO	FORCE (LBS)	VERT. LOAD (PLF)	CS1 (LC)	FR-TO	FORCE (LBS)	CS1 (LC)	
F-A	-846/0	0.0	0.0 0.23 (1)	A-E	0/1072	0.35 (1)	
A-B	-869/0	-114.3	-114.3 0.24 (1)	E-B	-832/0	0.18 (1)	
B-C	-869/0	-114.3	-114.3 0.24 (1)	E-C	0/1072	0.35 (1)	
D-C	-846/0	0.0	0.0 0.23 (1)				
F-G	0/0	-18.5	-18.5 0.24 (1)				
G-H	0/0	-18.5	-18.5 0.24 (1)				
H-E	0/0	-18.5	-18.5 0.24 (1)				
E-I	0/0	-18.5	-18.5 0.24 (1)				
I-J	0/0	-18.5	-18.5 0.24 (1)				
J-D	0/0	-18.5	-18.5 0.24 (1)				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
G	1-9-12	-180	-180	---	FRONT	VERT	TOTAL	---	C1
H	3-9-12	-180	-180	---	FRONT	VERT	TOTAL	---	C1
I	5-9-12	-180	-180	---	FRONT	VERT	TOTAL	---	C1
J	7-9-12	-180	-180	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 51 lb

(M/R)

DESIGN CRITERIA

SPECIFIED LOADS:		
TOP CH.	LL	25.6 PSF
DL		15.0 PSF
BOT CH.	LL	0.0 PSF
DL		7.4 PSF
TOTAL LOAD		48.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.31")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.31")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CS1: TC=0.24/1.00 (B-C:1), BC=0.24/1.00 (D-E:1),
WB=0.35/1.00 (A-E:1), SS1=0.29/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP(DRY)	SHEAR (PS)	SECTION (PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1887 788	1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.76 (E) (INPUT = 0.90)
JSI METAL = 0.32 (E) (INPUT = 1.00)

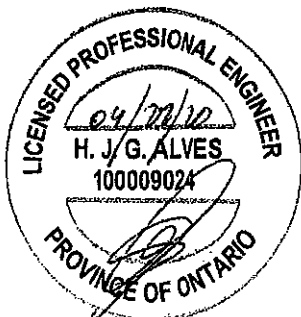

Structural component only
DWG# T-2007121

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	T54	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:30 2020 Page 1
ID:7vF?aG0E03cRU8X1)SrKzIWK-UIF5jA4Dj2jVFWw6xLMSr9sN4hadRnVJap9lrOzNCOF

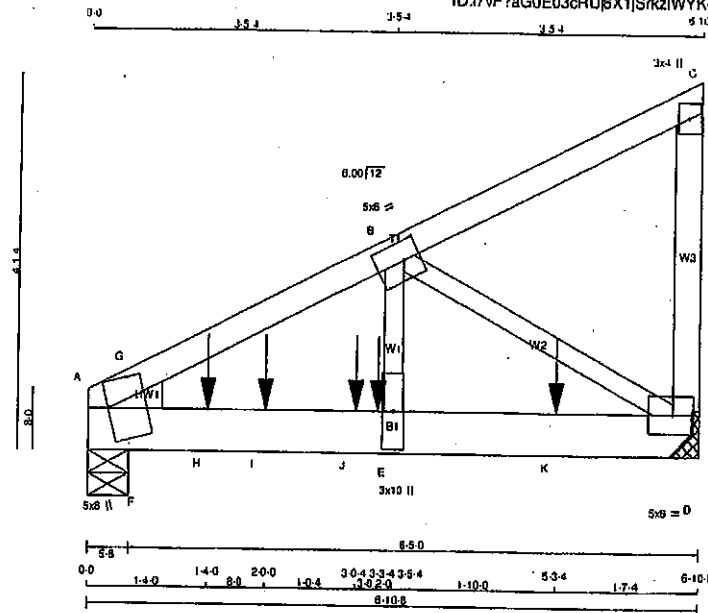

Scale = 1/2\"/>

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No. 2
D - C	2x4	DRY	No. 2
A - D	2x6	DRY	No. 2
ALL WEBS	2x3	DRY	No. 2
DRY: SEASONED LUMBER.			

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A- C	1	12
C- D	1	12
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
A- D	2	12
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	1	8

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (tablets in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TBMH1+m	MT20	5.0	8.0	3.50	
B	TMWV1	MT20	5.0	8.0	2.50	2.25
C	TMV+p	MT20	3.0	4.0		
D	BMVW1+1	MT20	5.0	8.0	2.50	2.75
E	BMV+w	MT20	3.0	10.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	HEEL WEDGE
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
A	3467	0	3467	0	0	5-8
D	2454	0	2454	0	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE
A	2449	1822 / 0	0 / 0	0 / 0
D	1735	1144 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.16 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)
FR-TO			
A-G	-4978 / 0	-91.8 -91.8 0.19 (1)	4.16
G-B	-3863 / 0	-91.8 -91.8 0.17 (1)	4.66
B-C	-13 / 0	-91.8 -91.8 0.07 (1)	8.25
D-C	-129 / 0	0.0 0.0 0.02 (1)	7.81
FR-TO			
A-F	0 / 3490	-18.5 -18.5 0.25 (1)	10.00
F-H	0 / 3490	-18.5 -18.5 0.88 (1)	10.00
H-I	0 / 3490	-18.5 -18.5 0.88 (1)	10.00
I-J	0 / 3490	-18.5 -18.5 0.88 (1)	10.00
J-E	0 / 3490	-18.5 -18.5 0.88 (1)	10.00
E-K	0 / 3490	-18.5 -18.5 0.49 (1)	10.00
K-D	0 / 3490	-18.5 -18.5 0.49 (1)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
H	1-4-0	-1376	---	---	BACK	VERT	TOTAL	---	C1
I	2-0-0	-1000	---	---	FRONT	VERT	TOTAL	---	C1
J	3-0-4	-894	---	---	FRONT	VERT	TOTAL	---	C1
J	3-3-4	-896	---	---	BACK	VERT	TOTAL	---	C1
K	5-3-4	-896	---	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 30 = 60 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL =	25.8	PSF
DL =	6.0	PSF	
BOT CH.	LL =	0.0	PSF
DL =	7.4	PSF	
TOTAL LOAD =	39.0	PSF	

SPACING = 24.0 IN. O.C

*** NON STANDARD GIRDER ***

ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.23")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.23")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.18/1.00 (A-G:1), BC=0.68/1.00 (E-F:1), WB=0.53/1.00 (B-D:1), SS=0.80/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.88 (B) (INPUT = 0.90)
JSI METAL = 0.70 (A) (INPUT = 1.00)

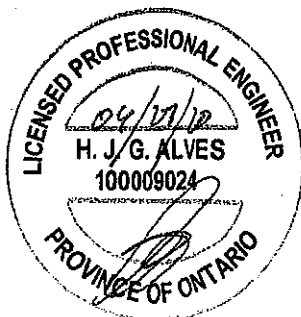


Structural component only
DWG# T-2007122

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408150	G60	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:02:39 2020 Page 1
ID:37VF7aG0E03cRUj6X1iSkzIWKk-kwCWPUL9QwEw4tkeulc_ECPgnD4MnCBFXZZr4QzNCnk

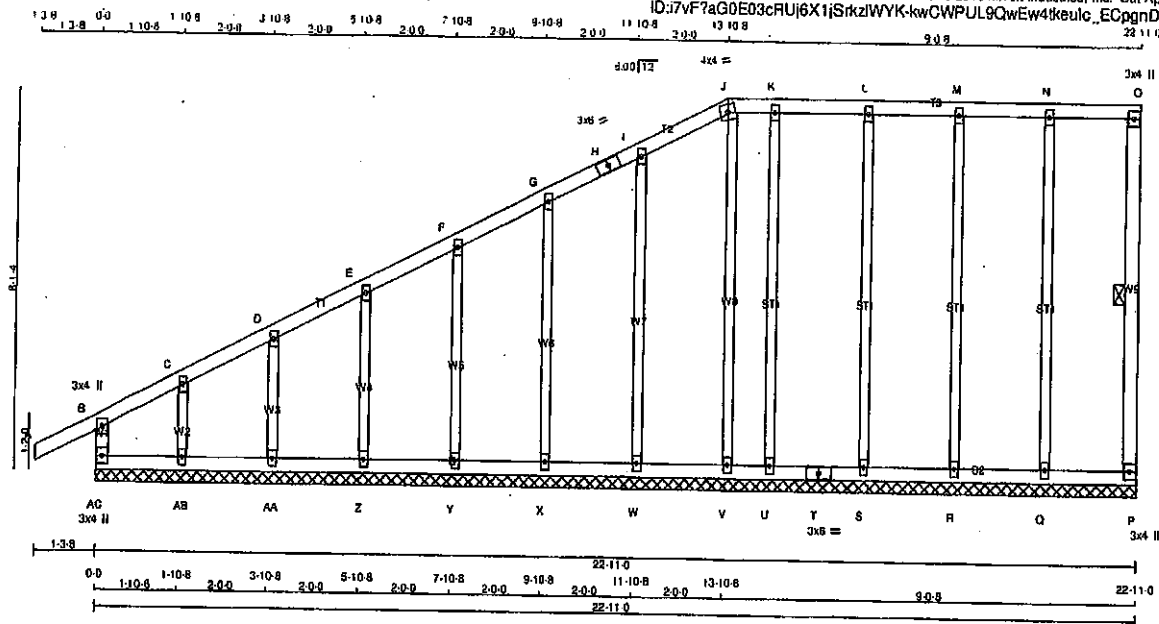

TOTAL WEIGHT = 4 X 116 = 464 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
AC - B	2x4	DRY	No.2
A - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
J - O	2x4	DRY	No.2
P - O	2x4	DRY	No.2
AC - T	2x4	DRY	No.2
T - P	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			
GABLE STUDS SPACED AT 2'-0\"			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF O-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO				FR-TO			
AC-B	-224 / 0	0.0	0.02 (1)	Q-N	-195 / 0	0.25 (1)	
A-B	0 / 28	-91.8	-91.8 0.12 (1)	R-M	-183 / 0	0.23 (1)	
B-C	-28 / 0	-91.8	-91.8 0.04 (1)	S-L	-188 / 0	0.24 (1)	
C-D	-19 / 0	-91.8	-91.8 0.04 (1)	U-K	-136 / 0	0.17 (1)	
D-E	-15 / 0	-91.8	-91.8 0.04 (1)	V-J	-131 / 0	0.17 (1)	
E-F	-11 / 0	-91.8	-91.8 0.04 (1)	W-I	-185 / 0	0.17 (1)	
F-G	-8 / 0	-91.8	-91.8 0.04 (1)	X-G	-183 / 0	0.11 (1)	
G-H	-6 / 0	-91.8	-91.8 0.04 (1)	Y-F	-182 / 0	0.07 (1)	
H-I	-6 / 0	-91.8	-91.8 0.04 (1)	Z-E	-182 / 0	0.05 (1)	
I-J	-6 / 0	-91.8	-91.8 0.04 (1)	AA-D	-183 / 0	0.03 (1)	
J-K	-2 / 0	-91.8	-91.8 0.03 (1)	AB-C	-178 / 0	0.03 (1)	
K-L	-2 / 0	-91.8	-91.8 0.04 (1)				
L-M	-2 / 0	-91.8	-91.8 0.04 (1)				
M-N	-2 / 0	-91.8	-91.8 0.04 (1)				
N-O	-2 / 0	-91.8	-91.8 0.04 (1)				
P-O	-81 / 8	0.0	0.01 (1)				
AC-AB	0 / 24	-18.5	-18.5 0.02 (4)				
AB-AA	0 / 17	-18.5	-18.5 0.02 (4)				
AA-Z	0 / 13	-18.5	-18.5 0.02 (4)				
Z-Y	0 / 10	-18.5	-18.5 0.02 (4)				
Y-X	0 / 7	-18.5	-18.5 0.01 (4)				
X-W	0 / 5	-18.5	-18.5 0.02 (4)				
W-V	0 / 4	-18.5	-18.5 0.02 (4)				
V-U	0 / 2	-18.5	-18.5 0.01 (4)				
U-T	0 / 2	-18.5	-18.5 0.02 (4)				
T-S	0 / 2	-18.5	-18.5 0.02 (4)				
S-R	0 / 2	-18.5	-18.5 0.02 (4)				
R-Q	0 / 2	-18.5	-18.5 0.02 (4)				
Q-P	0 / 2	-18.5	-18.5 0.02 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2018
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (Q-R:4), WB=0.25/1.00 (N-Q:1), SS=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN MAX MIN MAX MIN		
MT20	618 354 1667 788 1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.60 (J) (INPUT = 0.90)

JSI METAL = 0.08 (J) (INPUT = 1.00)

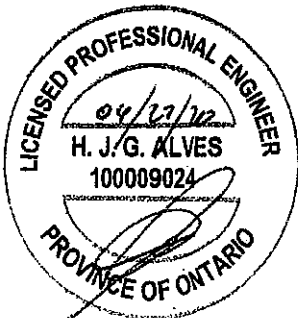


Structural component only
DWG# T-2007057

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408150	GP1	2	1	GREEN PARK HOMES		

Tamrack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 11:02:40 2020 Page 1
ID:17vF?aG0E03cRUj6X1jSkzlWYK-C6mudqMnBDMnh0JqS07DnQMfcNpWgWomDIPdszNCn

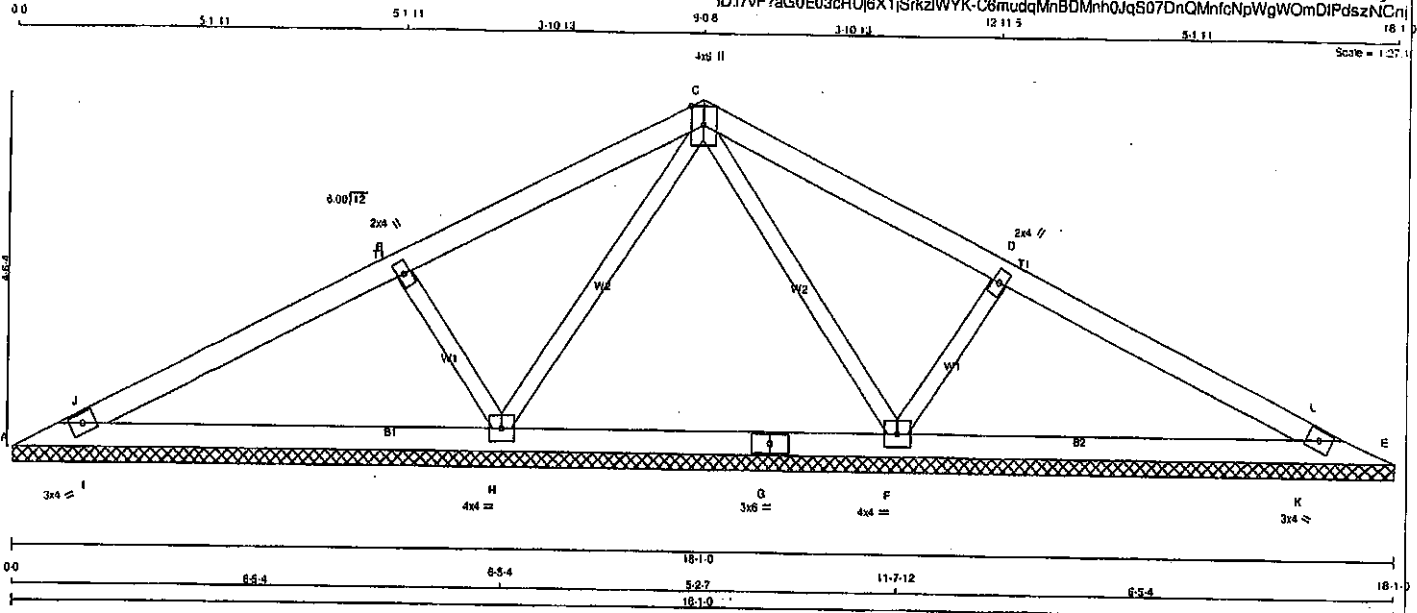

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCH.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
A - G	2x4	DRY	No.2	SPF
G - E	2x4	DRY	No.2	SPF
ALL WEBS 2x3 DRY No.2 SPF				
DRY: SEASONED LUMBER.				

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TBM1-h	MT20	3.0	4.0
B	TMW-w	MT20	2.0	4.0
C	TTWW-p	MT20	4.0	6.0 Edge
D	TMW-w	MT20	2.0	4.0
E	TBM1-h	MT20	3.0	4.0
F	BMWW1-t	MT20	4.0	4.0
G	BS-t	MT20	3.0	6.0
H	BMWW1-t	MT20	4.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
A	134	0	134	0	18-1-0 (9-11-12)1-0
E	134	0	134	0	18-1-0 (9-11-12)1-0
F	883	0	883	0	18-1-0 (9-11-12)1-0
H	883	0	883	0	18-1-0 (9-11-12)1-0

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	COMBINED	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	94	88 / 0	0 / 0	0 / 0	0 / 0	28 / 0	0 / 0	0 / 0
E	94	88 / 0	0 / 0	0 / 0	0 / 0	28 / 0	0 / 0	0 / 0
F	811	385 / 0	0 / 0	0 / 0	0 / 0	218 / 0	0 / 0	0 / 0
H	811	385 / 0	0 / 0	0 / 0	0 / 0	218 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, F, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)
MEMB.	FR-TO	FROM	TO	FROM	TO	FROM	TO	FROM	TO
A-J	0 / 240	-91.8	-91.8	0.12 (1)	10.00	C-F	-428 / 0	0.18 (1)	0.08 (1)
J-B	0 / 301	-91.8	-91.8	0.34 (1)	10.00	F-D	-436 / 0	0.18 (1)	0.08 (1)
B-C	0 / 503	-91.8	-91.8	0.37 (1)	10.00	H-C	-428 / 0	0.18 (1)	0.08 (1)
C-D	0 / 503	-91.8	-91.8	0.37 (1)	10.00	B-H	-436 / 0	0.18 (1)	0.08 (1)
D-L	0 / 301	-91.8	-91.8	0.34 (1)	10.00	I-J	-76 / 35	0.00 (1)	0.00 (1)
L-E	0 / 240	-91.8	-91.8	0.12 (1)	10.00	K-L	-76 / 35	0.00 (1)	0.00 (1)
A-I	-255 / 0	-18.5	-18.5	0.11 (1)	6.25				
I-H	-243 / 0	-18.5	-18.5	0.13 (4)	6.25				
H-G	-246 / 0	-18.5	-18.5	0.13 (4)	6.25				
G-F	-248 / 0	-18.5	-18.5	0.13 (4)	6.25				
F-K	-243 / 0	-18.5	-18.5	0.13 (4)	6.25				
K-E	-255 / 0	-18.5	-18.5	0.11 (1)	6.25				

TOTAL WEIGHT = 2 X 54 = 107 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

OSI: TC=0.37/1.00 (C-D:1), BC=0.13/1.00 (F-K:4), WB=0.18/1.00 (C-H:1), SSI=0.17/1.00 (D-L:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSD) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.48 (H) (INPUT = 0.80)
JSI METAL= 0.15 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007058

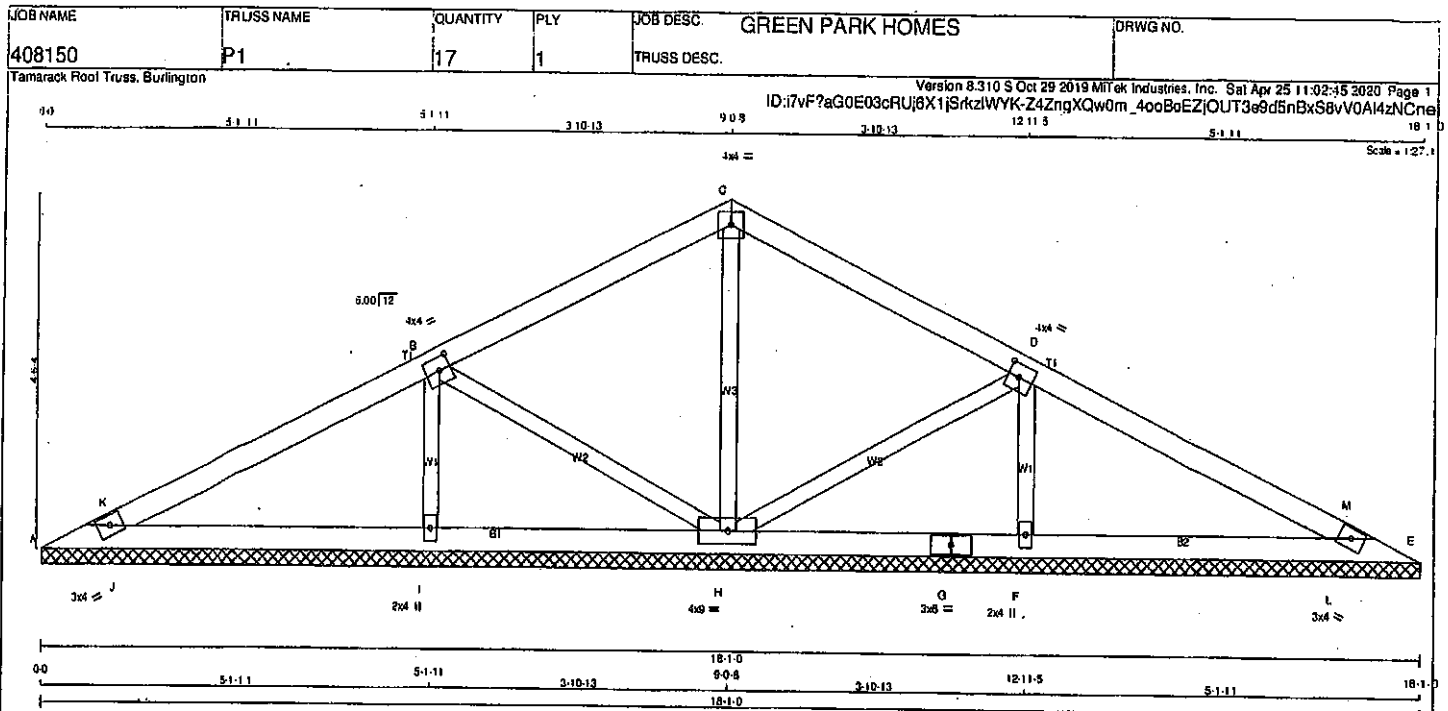

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
A - G	2x4	DRY	No.2	SPF
G - E	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2
 DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TBM1-h	MT20	3.0	4.0		
B	TBMWW-1	MT20	4.0	4.0	2.00	1.75
C	TTW-p	MT20	4.0	4.0		
D	TBMWW-1	MT20	4.0	4.0	2.00	1.75
E	TBM1-h	MT20	3.0	4.0		
F	BMW1-w	MT20	2.0	4.0		
G	BS-1	MT20	3.0	6.0		
H	BMW1-w	MT20	4.0	9.0		
I	BMW1-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
A	124	0	124	0	18-1-0 (11-11489)-0	
E	124	0	124	0	18-1-0 (11-11489)-0	
H	415	0	415	0	18-1-0 (11-11489)-0	
F	666	0	666	0	18-1-0 (11-11489)-0	
I	666	0	666	0	18-1-0 (11-11489)-0	

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX./MIN. COMPONENT REACTIONS				
		SNOW	LIVE	PERM.LIVE	WIND	DEAD
A	87	59/0	0/0	0/0	0/0	28/0
E	87	59/0	0/0	0/0	0/0	28/0
H	293	192/0	0/0	0/0	0/0	101/0
F	471	307/0	0/0	0/0	0/0	164/0
I	471	307/0	0/0	0/0	0/0	164/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, H, F, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
A-K	0/248	-91.8	-91.8 0.07 (1)	10.00	H-C	-445/0	0.13 (1)
K-B	0/292	-91.8	-91.8 0.32 (1)	10.00	H-D	0/59	0.01 (1)
B-C	0/189	-91.8	-91.8 0.30 (1)	10.00	F-D	-528/0	0.08 (1)
C-D	0/188	-91.8	-91.8 0.30 (1)	10.00	B-H	0/59	0.01 (1)
D-M	0/292	-91.8	-91.8 0.32 (1)	10.00	I-B	-528/0	0.08 (1)
M-E	0/248	-91.8	-91.8 0.07 (1)	10.00	J-K	-128/8	0.00 (1)
					L-M	-128/8	0.00 (1)
A-J	-258/0	-18.5	-18.5 0.14 (1)	6.25			
J-I	-240/0	-18.5	-18.5 0.14 (1)	6.25			
I-H	-240/0	-18.5	-18.5 0.11 (1)	6.25			
H-G	-240/0	-18.5	-18.5 0.11 (1)	6.25			
G-F	-240/0	-18.5	-18.5 0.11 (1)	6.25			
F-L	-240/0	-18.5	-18.5 0.14 (1)	6.25			
L-E	-258/0	-18.5	-18.5 0.14 (1)	6.25			

TOTAL WEIGHT = 17 X 55 = 943 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOY CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.32/1.00 (D-M:1), BC=0.14/1.00 (F-L:1), WB=0.13/1.00 (C-H:1), SSI=0.17/1.00 (D-M:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.51 (B) (INPUT = 0.90)


JSI METAL= 0.13 (C) (INPUT = 1.00)



Structural component only
 DWG# T-2007062

JOB NAME 408151	TRUSS NAME PB20	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 11:19:42 2020 Page 1
ID:h2dlqC44wS_E2l2qPs_atzIRw-HKWF6HjVE7m4RFJfStCxbPKbCR_v_qmDtUUDzNCXI

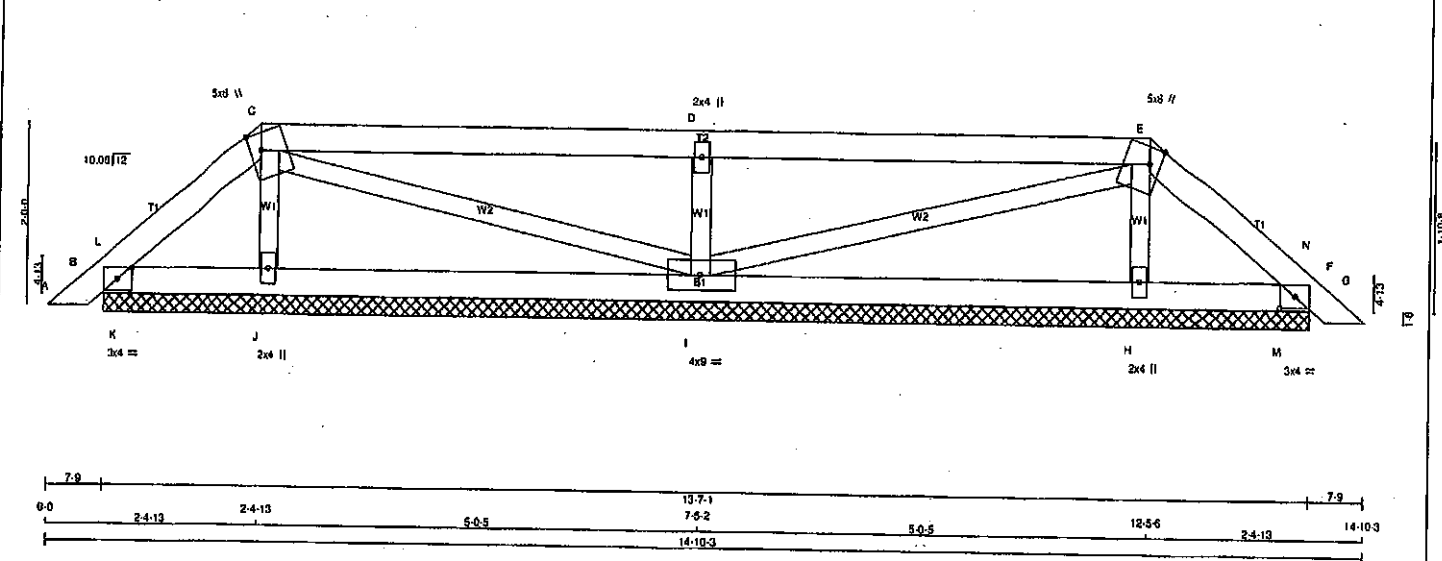

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
B - F	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMB1-I	MT20	3.0	4.0	1.50 2.00
C	TTWW+m	MT20	5.0	6.0	2.25 1.50
D	TMW+w	MT20	2.0	4.0	
E	TTWW+m	MT20	5.0	6.0	2.25 1.50
F	TMB1-I	MT20	3.0	4.0	1.50 2.00
H	BMW1+w	MT20	2.0	4.0	
I	BMWWW1-I	MT20	4.0	9.0	
J	BMW1+w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		REQD BRG
	VERT	HORZ	DOWN	HORZ	
B	189	0	189	0	13-7-1
F	189	0	189	0	13-7-1
J	288	0	288	0	13-7-1
I	683	0	683	0	13-7-1
H	288	0	288	0	13-7-1

UNFACTORED REACTIONS

JT	1ST CASE		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
B	116	93/0	0/0	0/0	0/0	23/0	0/0
F	116	93/0	0/0	0/0	0/0	23/0	0/0
J	207	118/0	0/0	0/0	0/0	89/0	0/0
I	481	327/0	0/0	0/0	0/0	154/0	0/0
H	207	118/0	0/0	0/0	0/0	89/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, F, J, I, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	MAX. CS (LC)
FR-TO	0/14	-91.8	-91.8 0.02 (1)	FR-TO	0/14	-91.8	-91.8 0.02 (1)
A-B	0/14	-91.8	-91.8 0.02 (1)	J-C	-194/0	0.03 (1)	0.03 (1)
B-L	-31/4	-91.8	-91.8 0.01 (1)	C-I	-22/0	0.01 (1)	0.01 (1)
L-C	-60/0	-91.8	-91.8 0.03 (1)	I-D	-576/0	0.08 (1)	0.08 (1)
C-D	-9/0	-91.8	-91.8 0.39 (1)	D-E	-22/0	0.01 (1)	0.01 (1)
D-E	-9/0	-91.8	-91.8 0.39 (1)	E-H	-194/0	0.03 (1)	0.03 (1)
E-N	-60/0	-91.8	-91.8 0.03 (1)	H-L	-121/0	0.00 (1)	0.00 (1)
N-F	-31/4	-91.8	-91.8 0.01 (1)	L-M	-121/0	0.00 (1)	0.00 (1)
F-G	0/14	-91.8	-91.8 0.02 (1)				
B-K	0/42	-18.5	-18.5 0.04 (1)				
K-J	0/42	-18.5	-18.5 0.07 (4)				
J-I	0/29	-18.5	-18.5 0.10 (4)				
I-H	0/29	-18.5	-18.5 0.10 (4)				
H-M	0/42	-18.5	-18.5 0.07 (4)				
M-F	0/42	-18.5	-18.5 0.04 (1)				

TOTAL WEIGHT = 2 X 45 = 90 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.39/1.00 (C-D-1), BC=0.10/1.00 (I-J-4), WB=0.08/1.00 (D-4-1), SSI=0.22/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 616 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.30 (D) (INPUT = 0.80)
JSI METAL = 0.12 (D) (INPUT = 1.00)




Structural component only
DWG# T-2007080

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408150	U1	21	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 9.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:02:42 2020 Page 1
ID:17vF?aG0E03cRUj8X1jSrkzIWK-9Vf1WN1jrcVxKTOZR9hsR4TQ31_cmhDXnWhzNCnh

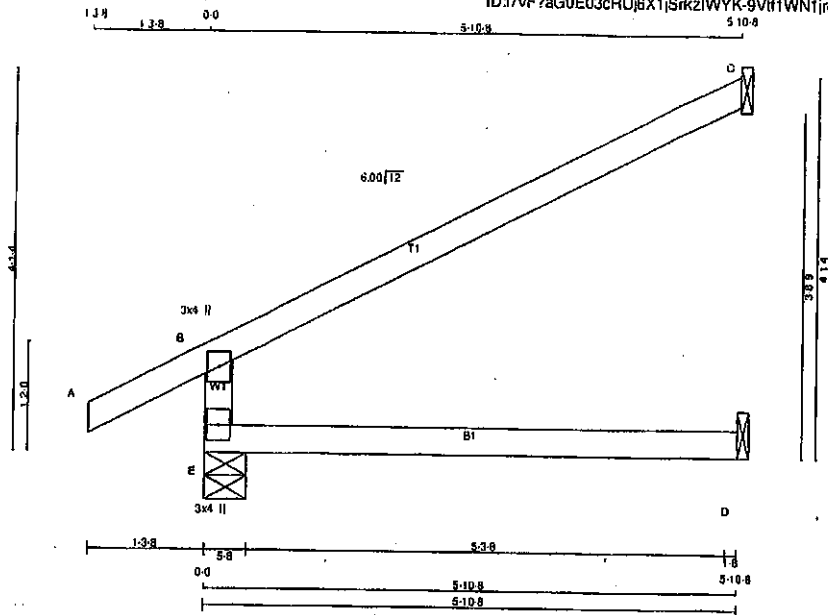

TOTAL WEIGHT = 21 X 17 = 353 lb

LUMBER			
N.L.G.A. RULES	SIZE	LUMBER	DESCR.
CHORDS	2x4	DRY	No.2
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REORD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX
E	525	0	525	0	0	5-8	5-8	
C	202	0	202	0	0	1-8	1-8	
D	45	0	50	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOASE	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	369	257/0	0/0	0/0	0/0	111/0	0/0
C	139	113/0	0/0	0/0	0/0	26/0	0/0
D	38	0/0	0/0	0/0	0/0	38/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
E-B	-461 / 0	0.0	0.0	0.13 (4)	7.31		
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00		
B-C	-30 / 0	-91.8	-91.8	0.54 (1)	8.25		
E-D	0 / 0	-18.5	-18.5	0.13 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8	PSF
DL = 8.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.4	PSF	
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN.CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.03")

CSI: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1667 788	1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.19 (E) (INPUT = 0.30)

JSI METAL = 0.13 (B) (INPUT = 1.00)

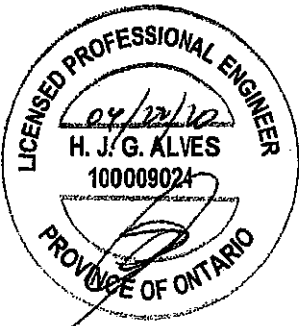


Structural component only
DWG# T-2007059

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408150	U2	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:02:43 2020 Page 1
ID:7vF7aG0E03cRU8X1jSkziWYK-dhR1Fr0U8kMYU2P78gwP2_KzqQl30rSBX3DBzNCng

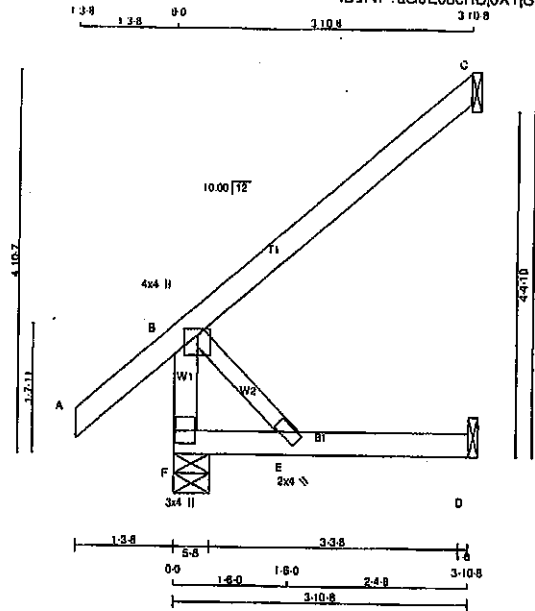

Scale = 1:27.0

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR
F - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS		2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
E	BMVW+p	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG
	VERT	HORZ	DOWN	HORZ
F	341	0	341	0
C	178	0	178	0
D	38	0	40	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS	PERM	LIVE	WIND	DEAD	SOIL
F	239	170 / 0	0 / 0	0 / 0	0 / 0	0 / 0	89 / 0	0 / 0
C	122	99 / 0	0 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0
D	29	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	29 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS			WEBS		
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO	MAX. UNBRAC LENGTH	FR-TO	MAX. CSI (LC)
F-B	-305 / 0	0.0 0.0	0.03 (1)	B-E	0 / 0
A-B	0 / 41	-91.8 -91.8	0.14 (5)		0.00 (1)
B-C	0 / 0	-91.8 -91.8	0.23 (1)		
F-E	0 / 0	-18.5 -18.5	0.08 (4)		
E-D	0 / 0	-18.5 -18.5	0.08 (4)		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 15 lb (lb)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2018
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.01")

CSI: TC=0.23/1.00 (B-C:1), BC=0.08/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (B) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007060

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408150	J3	6	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:02:44 2020 Page 1
ID:7vF7aG0E03cRUj6X1jSkzjWYK-5u7PSBPfFSsDAedbsB9xGWUuEIBSWG_hrGcmdzNCnf

Scale = 1:11.5

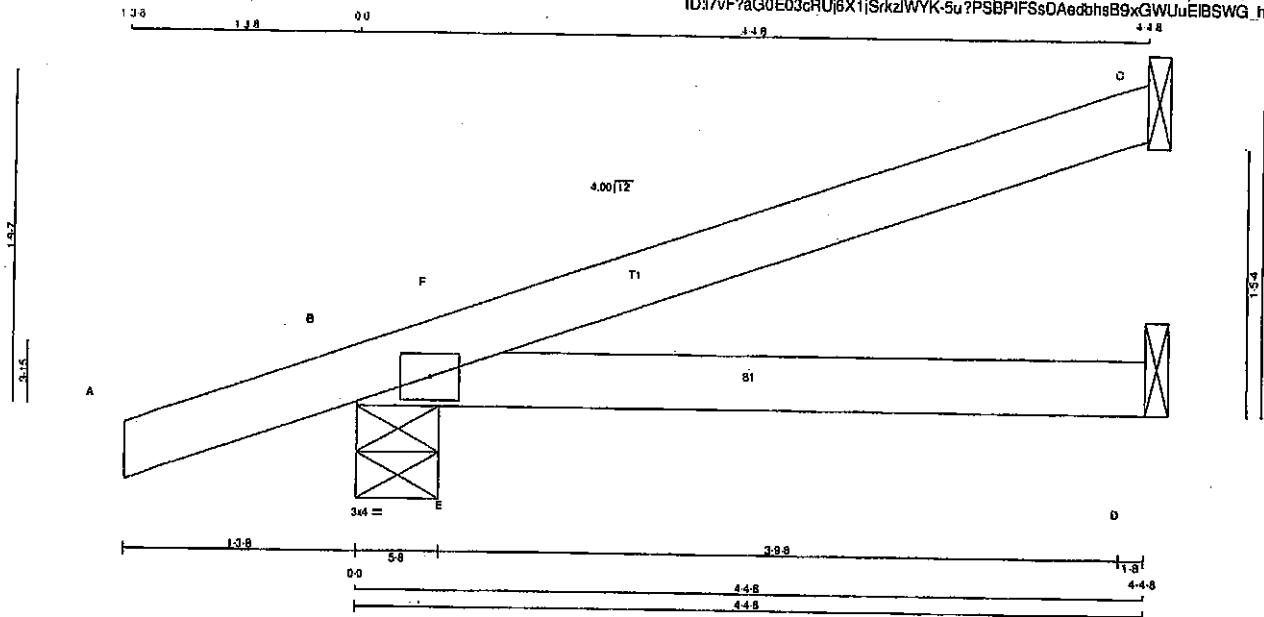

LUMBER				DESCR.	
N. L. G. A. RULES	SIZE	LUMBER		SPF	SPF
CHORDS					
A - C	2x4	DRY	No.2		
B - D	2x4	DRY	No.2		

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
C	174	0	174	0	1-8	1-8		
B	384	0	384	0	5-8	5-8		
D	68	0	68	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOASE		MAX/MIN. COMPONENT REACTIONS		PERM	LIVE	WIND	DEAD	SOIL
	COMBINED	SNOW	SNOW	LIVE					
C	120	93/0	0/0	0/0	0/0	0/0	27/0	0/0	0/0
B	255	180/0	0/0	0/0	0/0	0/0	75/0	0/0	0/0
D	50	19/0	0/0	0/0	0/0	0/0	32/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	LENGTH FR-TO	E-F	
A-B	0/18	-91.8 -91.8	0.11 (1)	10.00	-194/7
B-F	-14/0	-91.8 -91.8	0.05 (4)	6.25	
F-C	0/2	-91.8 -91.8	0.22 (1)	10.00	
B-E	0/0	-18.5 -18.5	0.17 (1)	10.00	
E-D	0/0	-18.5 -18.5	0.17 (1)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.8 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.02")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.05")

CSI: TC=0.22/1.00 (C-F:1), BC=0.17/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SSI=0.18/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PS)	(PL)	(PL)
	MAX	MIN	MAX
MT20	618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (B) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007061

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	J40	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 11:28:29 2020 Page 1
ID:7vF7aG0E03cRUj8X1jSkzIWK-bIU8J?Q2Gb4UDlp3CRUXVjVnrDY0P6E12Z2b6zNCOa

Scale = 1/2" = 1'-0"

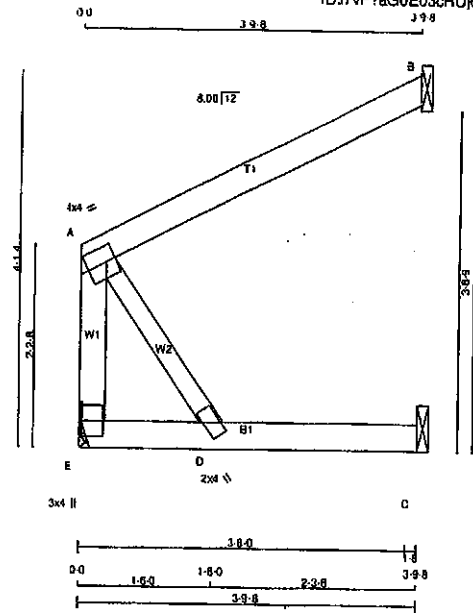

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
E - A	2x4	DRY	No.2
A - B	2x4	DRY	No.2
E - C	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW-1	MT20	4.0	4.0	2.00 1.25
D	BMW-w	MT20	2.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	DOWN	UP	BRG
E	209	0	209	0	BRG
B	174	0	174	0	MECHANICAL
C	35	0	39	0	1-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	148	97/0	0/0	0/0	0/0	0/0	51/0	0/0
B	120	97/0	0/0	0/0	0/0	0/0	23/0	0/0
C	28	0/0	0/0	0/0	0/0	0/0	28/0	0/0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	MAX. FORCE (LBS)	VERT. LOAD	LC1 MAX
FR-TO		FROM	TO	FR-TO		FROM	TO
E-A	-174/0	0.0	0.0 0.02 (1)	A-D	0/0	0.0	0.0 (1)
A-B	0/0	-91.8	-91.8 0.22 (1)				
E-D	0/0	-18.5	-18.5 0.07 (4)				
D-C	0/0	-18.5	-18.5 0.08 (4)				

TOTAL WEIGHT = 4 X 13 = 52 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	8.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = 1/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = 1/999 (0.01")

CSI: TC=0.22/1.00 (A-B:1), BC=0.08/1.00 (C-D:4),
WB=0.00/1.00 (A-D:1), SSI=0.12/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 768	1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.11 (A) (INPUT = 0.90)
JSI METAL = 0.03 (A) (INPUT = 1.00)




Structural component only
DWG# T-2007105

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408152	J41	4	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:28:31 2020 Page 1
ID:17vF?aG0E03cRUj6X1jSkzIWYK-Y2cwkhrJoCKTbzSJsX?a8a7q0FFUJ5WDM29q_zNCOY

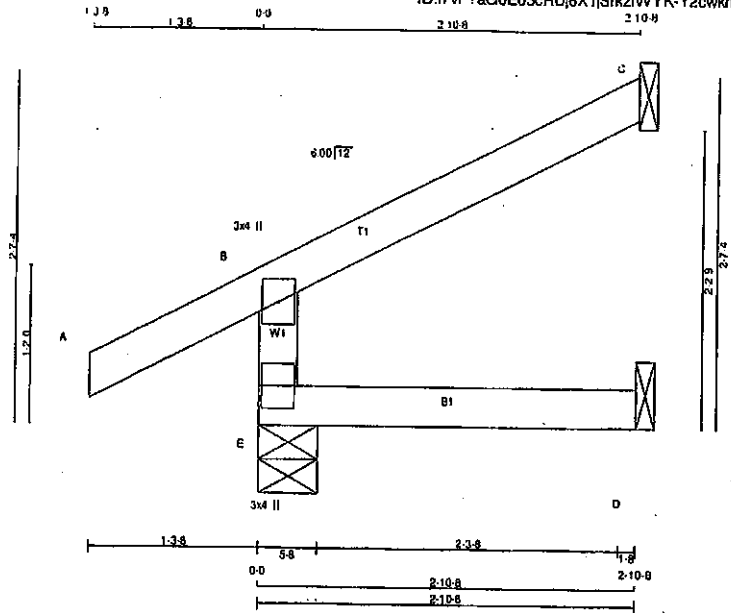

Scale = 1/16"

LUMBER				DESCR.	
N. L. G. A. RULES	SIZE	LUMBER		SPF	
CHORDS					
E - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION	DOWN	GROSS REACTION	DOWN	8RG	8RG	IN-SX	IN-SX
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	319	0	319	0	0	5-8	5-8
C	99	0	99	0	0	1-8	1-8
D	23	0	23	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST CASE	MAX/MIN	COMPONENT	REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
E	223	161/0	0/0	0/0	0/0	62/0	0/0
C	88	55/0	0/0	0/0	0/0	13/0	0/0
D	18	0/0	0/0	0/0	0/0	18/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	LENGTH	FR-TO
E-B	-289/0	0.0	0.0	0.02 (4)	7.81
A-B	0/28	-91.8	-91.8	0.13 (5)	10.00
B-C	-15/0	-91.8	-91.8	0.13 (1)	6.25
E-D	0/0	-18.5	-18.5	0.03 (4)	10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 4 X 10 = 38 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.00")

CSI: TC=0.13/1.00 (B-C:1), BC=0.03/1.00 (D-E:4), WB=0.00/1.00 (W:A:0), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MT20	818	354
	1667	788
	1987	1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.12 (E) (INPUT = 0.90)
JSI METAL = 0.08 (B) (INPUT = 1.00)

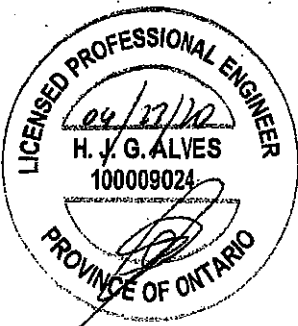


Structural component only
DWG# T-2007106

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408150	C1	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mit ek Industries, Inc. Sat Apr 25 11:02:37 2020 Page 1
ID:17vF?ag0E03cRUj6X1jSk2WYK-oX4m. oJvul. CqZaFmuZV9nkJVPNuJLXy4F4IXzNCnm

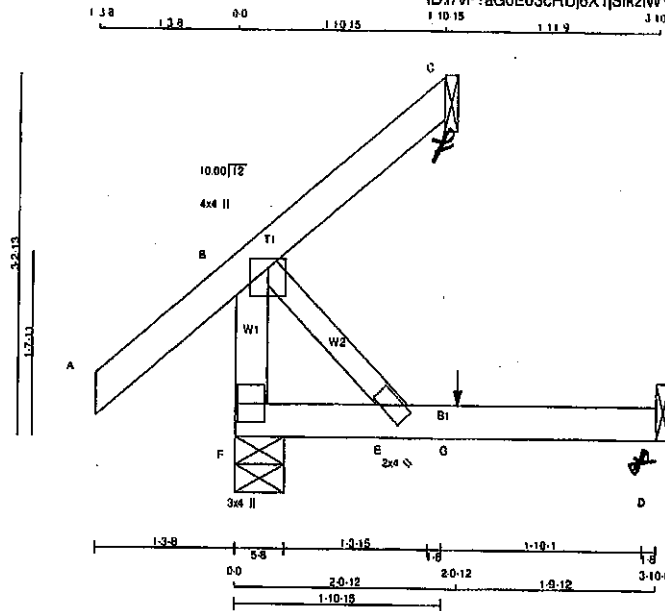

Scale = 1/16"

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DESCR.
SPF
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
F	297	0	297	0
C	42	0	42	0
D	38	0	40	0

SEE MITEK STANDARD DETAIL 897781H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	208	145/0	0/0	0/0	0/0	63/0	0/0
C	29	23/-28	0/0	0/0	0/0	5/0	0/0
D	29	0/0	0/0	0/0	0/0	29/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRAC LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO					FR-TO		
F-B	-281/0	0.0	0.0	0.03 (1)	B-E	0/0	0.00 (1)
A-B	0/41	-91.8	-91.8	0.14 (5)			
B-C	-29/0	-91.8	-91.8	0.14 (5)			
F-E	0/0	-18.5	-18.5	0.08 (4)			
E-G	0/0	-18.5	-18.5	0.08 (4)			
G-D	0/0	-18.5	-18.5	0.08 (4)			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	2-0-12	1	1	---	BACK	VERT.	TOTAL	---	C1

CONNECTION REQUIREMENTS

(1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.14/1.00 (A-B:5), BC=0.08/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), CSI=0.09/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1667
		788	1987
			1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP=0.20 (5) (INPUT = 0.90)

JSI METAL=0.05 (5) (INPUT = 1.00)

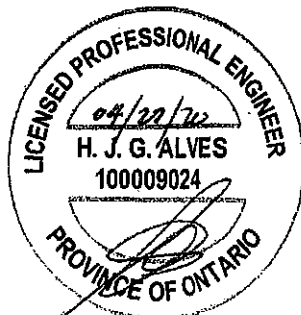

Structural component only
DWG# T-2007055

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408150	C2	1	1	GREEN PARK HOMES	
Tamarack Pool Truss, Burlington				TRUSS DESC.	

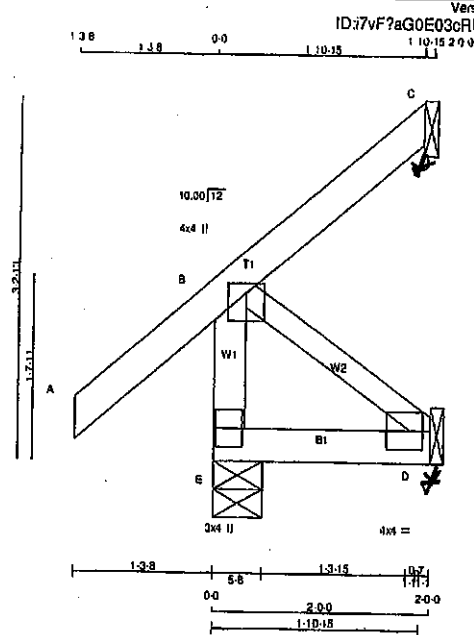

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS	2x4	DRY	No.2
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	4.0	1.00 2.00
D	BMV1-l	MT20	4.0	4.0	2.00 1.25
E	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION				MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQD BRG
JT	VERT	HORIZ		DOWN	HORIZ	UPLIFT	IN-SX	IN-SX
E	278	0		278	0	0	5-8	5-8
C	42	0		42	0	-36	1-8	1-8
D	18	0		20	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D
 PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS							
JT	1ST LOASE COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	184	145/0	0/0	0/0	0/0	48/0	0/0
C	28	23/-28	0/0	0/0	0/0	5/0	0/0
D	14	0/0	0/0	0/0	0/0	14/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
E-B	-261/0	0.0	0.03 (1)	7-8	0/0	0.00 (1)	
A-B	0/41	-91.8	-91.8 0.13 (1)	10.00			
B-C	-29/0	-91.8	-91.8 0.12 (1)	8.25			
E-D	0/0	-18.5	-18.5 0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:		
TOP CH. LL	=	25.6 PSF
DL	=	6.0 PSF
BOT CH. LL	=	0.0 PSF
DL	=	7.4 PSF
TOTAL LOAD	=	39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCB 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
 - OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL) = L/360 (0.19")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.13/1.00 (A-B:1) , BC=0.02/1.00 (D-E:4) ,
 WB=0.00/1.00 (B-C:1) , SS=0.00/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRP(DRY)	SHEAR	SECTION		
	(PSI)	(PLI)	(PLI)		
	MAX	MIN	MAX	MIN	MAX
MT20	618	354	1667	798	1987

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.20 (B) (INPUT = 0.90)
 JSI METAL= 0.05 (B) (INPUT = 1.00)



Structural component only
 DWG# T-2007056

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	C40	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:21 2020 Page 1					
ID: i7vF7aG0E03cRUj6X1jSkziWYK-q778eGk1873dG3CXklIA19Pt_o08nd2voddJZzNCOi					
Scale = 1:17.9					

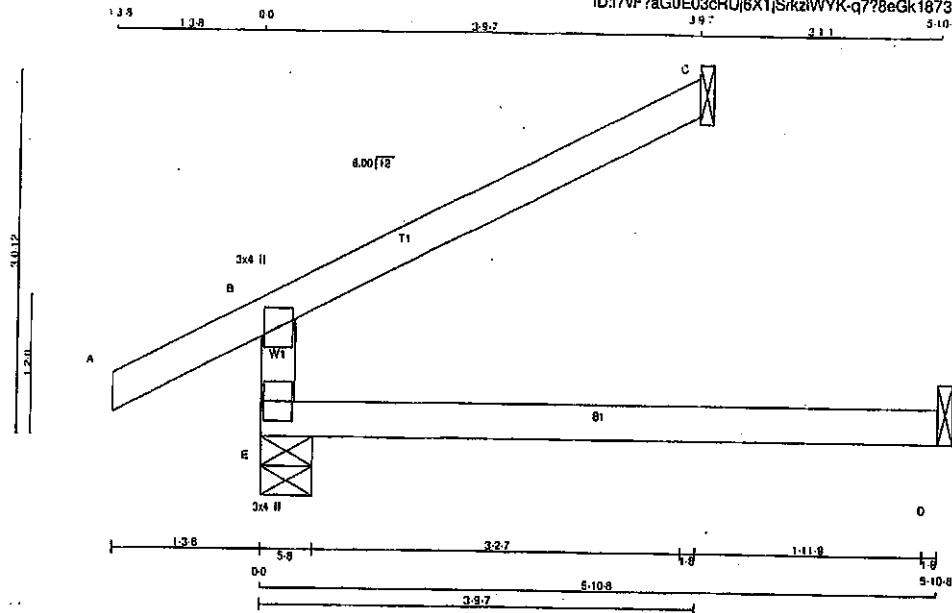

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4 DRY	No.2	SPF
A - C	2x4 DRY	No.2	SPF
E - D	2x4 DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQ'D BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
E	405	0	405	0	0
C	130	0	130	0	0
D	45	0	50	0	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST LCASE	MAX	MIN	COMPONENT REACTIONS	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM.	LIVE	WIND	
E	288	190	0	0	0	0	0
C	90	73	0	0	0	0	0
D	36	0	0	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
MEMB.	FR-TO		FROM TO		MEMB.		
E-B	-342	0	0	0.13 (4)	7.81		
A-B	0	-91.8	-91.8	0.12 (1)	10.00		
B-C	-19	-91.8	-91.8	0.22 (1)	6.25		
E-D	0	-18.5	-18.5	0.13 (4)	10.00		

TOTAL WEIGHT = 4 X 14 = 57 lb

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL	=	25.6 PSF
	DL	=	8.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.4 PSF
TOTAL LOAD		=	39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.03")

CSI: TC=0.22/1.00 (B-C:1), SC=0.13/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX	MIN	MAX
MT20	518	354
	1667	788
	1987	1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.14 (E) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007098

JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408152	C42	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:24 2020 Page 1

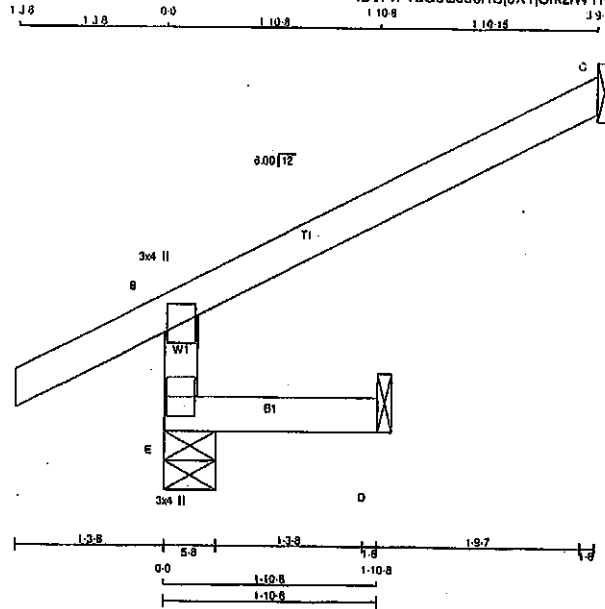

Scale = 1:18.2

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
		GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	0	DOWN	HORIZ	UPLIFT
E	361	0	361	0	0
C	130	0	130	0	0
D	18	0	17	0	0

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		MAX/MIN COMPONENT REACTIONS					
JT	1ST LCASE COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	250	190 / 0	0 / 0	0 / 0	0 / 0	60 / 0	0 / 0
C	90	73 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0
D	12	0 / 0	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FROM	TO	LENGTH	FR-TO
E-B	342 / 0	0.0	0.0	0.01 (4)	7.81
A-B	0 / 28	-91.8	-91.8	0.13 (5)	10.00
B-C	-19 / 0	-91.8	-91.8	0.22 (1)	6.25
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 4 X 10 = 38 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/899 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/899 (0.00")

CS1: TC=0.22/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (A:0), SS1=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1686

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (E) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)

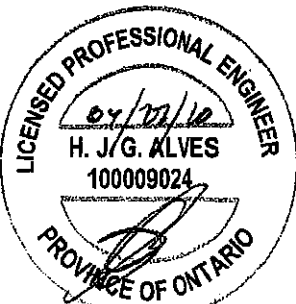


Structural component only
DWG# T-2007100

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408152	C43	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:25 2020 Page 1
ID:17vF7aG0E03cRUj8X1jSkzIwYK-jUEFTdnYCMa2lgWizbQbKik7UcCo4bcaqQbrSKzNCoe

Scale = 1:12.1

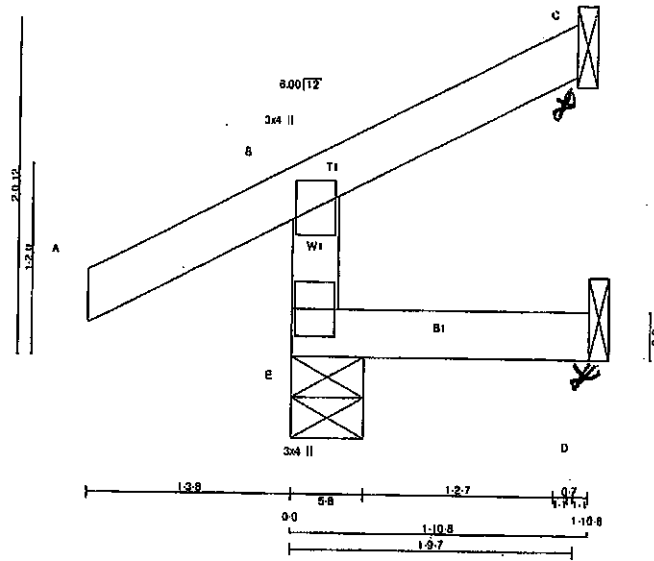

TOTAL WEIGHT = 4 X 7 = 28 lb

LUMBER				DESCR.	
N. L. G. A. RULES	SIZE	LUMBER		SPF	
CHORDS	2x4	DRY	No.2	SPF	
E - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	IN-SX	BRG
E	271	0	271	0	0	0	5-8	5-8	
C	45	0	45	0	-23	1-8	1-8	1-8	
D	8	0	17	0	-2	1-8	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS		1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
E	188	141/0	0/0	0/0	0/0	47/0	0/0		
C	31	24/-18	0/0	0/0	0/0	7/0	0/0		
D	7	0/-8	0/0	0/0	0/0	12/0	0/0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
E-B	-244/0	0.0	0.0 (5)	7.81			
A-B	0/28	-91.8	-91.8 (1)	10.00			
B-C	-17/0	-91.8	-91.8 (1)	6.25			
E-D	0/0	-18.5	-18.5 (5)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5), WS=0.00/1.00 (n/a:0), SS=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	818 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)

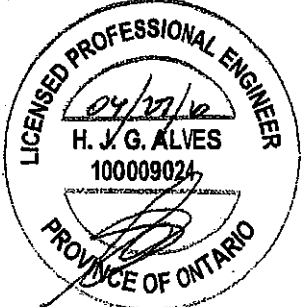

Structural component only
DWG# T-2007101

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	C44	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:26 2020 Page 1	

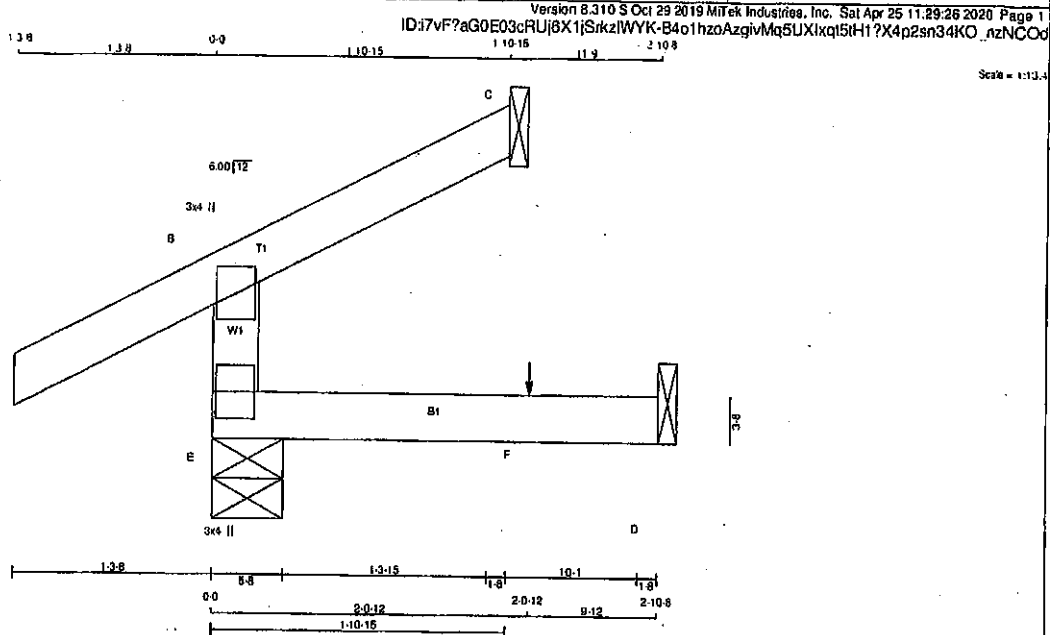

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS	2x4	DRY	SPF
E - B	2x4	DRY	SPF
A - C	2x4	DRY	SPF
E - D	2x4	DRY	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
E	264	0	264	0	5-8
C	66	0	66	0	1-8
D	23	0	28	0	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST CASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED								
E	185	130/10	0/0	0/0	0/0	0/0	0/0	55/0	0/0
C	48	37/0	0/0	0/0	0/0	0/0	0/0	9/0	0/0
D	18	0/0	0/0	0/0	0/0	0/0	0/0	18/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED VERT. LOAD LC1 MAX	MAX. UNBRACED LENGTH	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE LC1
MEMB.	FR-TO		FROM TO			MEMB.		
E-B	-234/0	0.0	0.0	0.02 (4)	7.81			
A-B	0/28	-91.8	-91.8	0.13 (5)	10.00			
B-C	-10/0	-91.8	-91.8	0.08 (1)	10.00			
E-F	0/0	-18.5	-18.5	0.03 (4)	10.00			
F-D	0/0	-18.5	-18.5	0.03 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)		JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	2-0-12	1	1	...	FRONT	VERT	TOTAL	...	C1		

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 2 X 8 = 17 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00")

CSI: TC=0.13/1.00 (A-B:5), BC=0.03/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SS1=0.10/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1887

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.10 (E) (INPUT = 0.90)
JSI METAL=0.08 (B) (INPUT = 1.00)

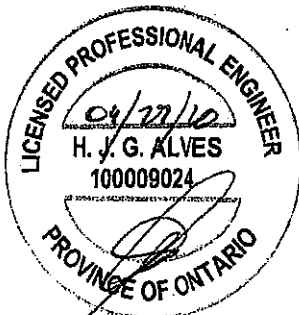


Structural component only
DWG# T-2007102

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	C45	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:27 2020 Page 1
ID:17vF?aG0E03cRUJ6X1|SfkzWYK-IHMPuJookzqm...gh40S3PIPT_PiZYV6xIk4xDzNCCo

Scale = 1:12.4

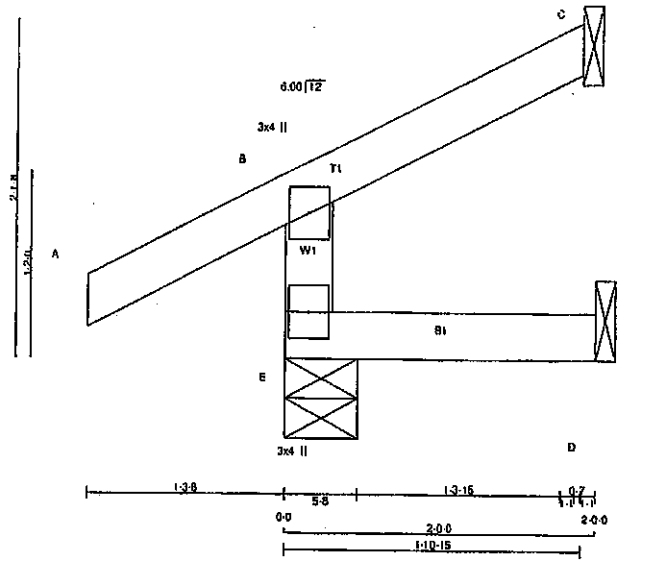

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS	2x4	DRY	SPF
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)			
JT TYPE	PLATES	W	LEN Y X
B TMV+p	MT20	3.0	4.0
E BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	GROSS REACTION	DOWN	GROSS REACTION	BRG	BRG
E	254	0	254	0	5-8
C	68	0	68	0	1-8
D	16	0	16	0	1-8

SEE MITEK STANDARD DETAIL B97791 H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST LCASE	MAX. MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
E	177	130/0	0/0	0/0	0/0	47/0
C	48	37/0	0/0	0/0	0/0	9/0
D	13	0/0	0/0	0/0	0/0	13/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX (PLF)	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	LENGTH	FR-TO
E-B	-234/0	0.0	0.0	0.01 (4)	7.81
A-B	0/23	-91.8	-91.8	0.12 (1)	10.00
B-C	-10/0	-91.8	-91.8	0.08 (1)	10.00
E-D	0/0	-18.5	-18.5	0.02 (4)	10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 2 X 7 = 15 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.90)

JSI METAL= 0.08 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007103

LUL/LUS/LJS/HUS/HHUS/HGUS

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.

Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:

- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1 1/2" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:

- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on p. 126.




Double-Shear
Nailing
Top View




Double-Shear
Nailing
Side View;
Do not
bend tab




Dome Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,680

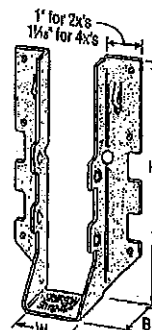


LUS28




LU26L

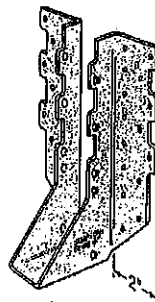


HUS210
(HUS26, HUS28,
and HHUS similar)



HGUS28-2




HHUS210-2



LJS26DS

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

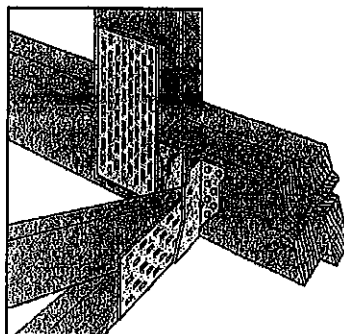

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options information on pp. 125–127.


HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
W < 2"	Bevel or square cut	0.62 of table value	0.46 of table value
2" < W < 6"	Bevel cut	0.67 of table value	0.41 of table value
2" < W < 6"	Square cut	0.46 of table value	0.41 of table value
W > 6"	Bevel cut	0.75 of table value	0.41 of table value

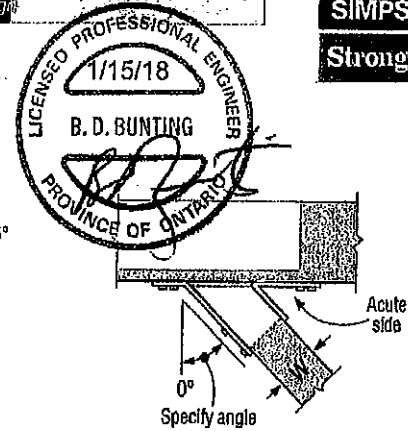

**Top View HHUS Hanger
Skewed Right**
(joist must be bevel cut)
All joist nails installed on the
outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _g ³	Header	Joist	D.Fir-L		S-P-F	
								Uplift (K _D = 1.15)	Normal (K _D = 1.00)	Uplift (K _D = 1.15)	Normal (K _D = 1.00)
								lb.	lb.	lb.	lb.
								kN	kN	kN	kN
Single 2x Sizes											
SS LUS24	18	1 1/8	3 1/4	1 1/4	2 1/4	(4) 10d	(2) 10d	710	1625	845	1155
								3.16	7.23	2.87	5.14
LU24L	22	1 1/8	3	1 1/4	2 1/8	(4) 10d	(2) 10d x 1 1/2"	360	1020	320	725
								1.60	4.54	1.42	3.22
LU26L	22	1 1/8	5	1 1/4	4%	(6) 10d	(4) 10d x 1 1/2"	720	1605	645	1140
								3.20	7.14	2.87	5.07
SS LUS26	18	1 1/8	4%	1 1/4	3 3/4	(4) 10d	(4) 10d	1420	2170	1290	1630
								6.32	9.65	5.74	7.25
SS HUS26	16	1%	5%	3	3 1/8	(14) 16d	(6) 16d	2705	4940	2065	3875
								11.90	21.97	9.20	17.24
LJS26DS	18	1 1/8	5	3 1/4	4%	(16) 16d	(6) 16d	2055	4265	1480	4115
								9.14	18.97	6.49	18.31
HGUS26	12	1%	5%	5	4%	(20) 16d	(8) 16d	2685	6625	2685	5700
								11.98	29.51	11.96	25.35
LU28L	20	1 1/8	8%	1 1/4	5%	(8) 10d	(6) 10d x 1 1/2"	1140	2185	1020	1550
								5.07	9.72	4.54	6.89
SS LUS28	18	1 1/8	6%	1 1/4	3%	(6) 10d	(4) 10d	1420	2520	1290	1790
								6.32	11.21	5.74	7.96
SS HUS28	16	1%	7 1/8	3	8 1/8	(22) 16d	(8) 16d	3605	5385	2675	4345
								16.04	23.86	11.90	19.33
HGUS28	12	1%	7 1/8	5	8%	(36) 16d	(12) 16d	3310	7675	3310	6900
								14.74	34.19	14.74	30.73
LU210L	20	1 1/8	8	1 1/4	7%	(10) 10d	(6) 10d x 1 1/2"	1140	2495	1020	1770
								5.07	11.10	4.54	7.87
SS LUS210	18	1 1/8	7 1/8	1 1/4	3%	(8) 10d	(4) 10d	1420	2785	1290	2210
								6.32	12.39	5.74	9.83


1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_g is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (In.)				Fasteners		Factored Resistance			
		W	H	B	d _g ^a	Header	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _p = 1.15)	(K _p = 1.00)	(K _p = 1.15)	(K _p = 1.00)
								lb.	lb.	lb.	lb.
								kN	kN	kN	kN
Double 2x Sizes											
LUS24-2	18	3 1/8	3 1/8	2	1 1/2	(4) 16d	(2) 16d	835	2020	590	1435
SS LUS26-2	18	3 1/8	4 1/8	2	4	(4) 16d	(4) 16d	3.71	8.99	2.62	6.38
HHUS26-2	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	1720	2595	1545	1920
HGUS26-2	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	7.65	11.54	6.87	8.54
SS LUS28-2	18	3 1/8	7	2	4	(6) 16d	(4) 16d	2850	7335	2065	5205
HHUS28-2	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	12.68	32.63	9.20	23.15
HGUS28-2	12	3 1/8	7 1/8	4	8 1/8	(36) 16d	(12) 16d	4385	8950	3110	6355
SS LUS210-2	18	3 1/8	9	2	6	(8) 16d	(6) 16d	19.51	39.81	13.83	28.27
HHUS210-2	14	3 1/8	9 1/8	3	8	(30) 16d	(10) 16d	1720	3325	1645	2575
HGUS210-2	12	3 1/8	9 1/8	4	10 1/8	(48) 16d	(16) 16d	7.65	14.79	6.87	11.45
								3785	8940	2675	6345
								16.75	39.77	11.90	28.22
								6070	12980	4310	9215
								27.00	57.74	19.17	40.99
								2580	4500	2320	3195
								11.48	20.02	10.32	14.21
								4670	9670	4235	7000
								20.77	42.97	18.84	31.14
								6840	14015	4855	10270
								30.43	62.34	21.60	45.69
Triple 2x Sizes											
HGUS26-3	12	4 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
HGUS28-3	12	4 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	19.51	39.81	13.83	28.27
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d	6070	12980	4310	9215
HGUS210-3	12	4 1/8	9 1/8	4	8 1/8	(48) 16d	(16) 16d	27.00	57.74	19.17	40.99
								4670	9670	4235	6865
								20.77	43.02	19.84	30.54
								6840	14645	4855	10400
								30.43	65.14	21.60	46.26
Quadruple 2x Sizes											
HGUS26-4	12	6 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
HGUS28-4	12	6 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	19.51	39.81	13.83	28.27
HHUS210-4	14	6 1/8	8 1/8	3	7 1/8	(30) 16d	(10) 16d	6070	12980	4310	9215
HGUS210-4	12	6 1/8	9 1/8	4	8 1/8	(48) 16d	(16) 16d	27.00	57.74	19.17	40.99
								4670	10155	4235	7210
								20.77	46.17	18.84	32.07
								6840	14645	4855	10400
								30.43	65.14	21.60	46.26
HGUS212-4	12	6 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	7840	14995	5425	10645
HGUS214-4	12	6 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	33.98	66.70	24.13	47.35
								10130	16400	7195	11645
								45.06	72.95	32.00	51.80
4x Sizes											
LUS46	18	3 1/8	4 1/8	2	3 1/8	(4) 16d	(4) 16d	1720	2595	1545	1920
HHUS46	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	7.65	11.54	6.87	8.54
HGUS46	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	2540	7335	2065	5205
LUS48	18	3 1/8	6 1/8	2	3 1/8	(6) 16d	(4) 16d	11.30	32.63	9.20	23.15
HHUS48	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	4385	8950	3110	6355
HGUS48	12	3 1/8	7 1/8	4	8 1/8	(36) 16d	(12) 16d	19.51	39.81	13.83	28.27
LUS410	18	3 1/8	8 1/8	2	5 1/8	(8) 16d	(6) 16d	1720	3325	1645	2575
HHUS410	14	3 1/8	9 1/8	3	8 1/8	(30) 16d	(10) 16d	7.65	14.79	6.87	11.45
HGUS410	12	3 1/8	9 1/8	4	10 1/8	(48) 16d	(16) 16d	3785	8940	2675	6345
LUS412	18	3 1/8	10 1/8	2	6 1/8	(12) 16d	(8) 16d	16.75	39.77	11.90	28.22
HHUS412	14	3 1/8	11 1/8	3	10 1/8	(42) 16d	(14) 16d	6070	12980	4310	9215
HGUS412	12	3 1/8	11 1/8	4	12 1/8	(66) 16d	(22) 16d	27.00	57.74	19.17	40.99
LUS414	18	3 1/8	12 1/8	2	7 1/8	(18) 16d	(12) 16d	2580	4500	2320	3195
HHUS414	14	3 1/8	13 1/8	3	11 1/8	(54) 16d	(18) 16d	11.48	20.02	10.32	14.21
HGUS414	12	3 1/8	13 1/8	4	14 1/8	(84) 16d	(28) 16d	6840	14015	4855	10270
								30.43	62.34	21.60	45.69
								7840	14995	5425	10645
								33.98	66.70	24.13	47.35
								10130	16400	7195	11645
								45.06	72.95	32.00	51.80



Plated Truss Connectors

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1/4". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

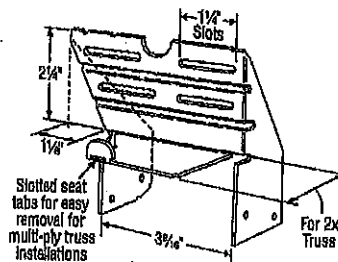


TC24
U.S. Patent 4,932,173

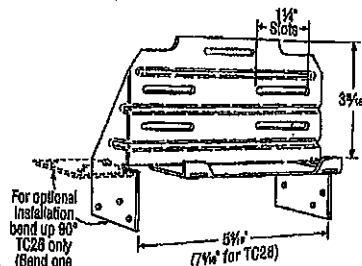


TC26
(TC28 Similar)

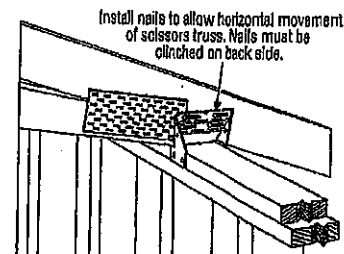

Typical TC24 Installation

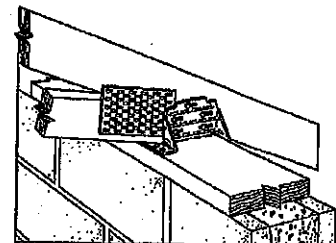

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer (8", 10", 12" Wall Installation Similar)

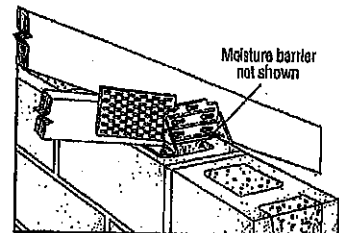

Optional TC28 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _o =1.15)	Uplift (K _o =1.15)
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(6) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _o =1.15)	Uplift (K _o =1.15)
TC26	(5) 10d	(6) 10d x 1 1/2"	810	660
	(5) 10d	(6) 10d	930	660

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.
2. Grout strength is 15 MPa minimum.
3. Optional TC28 installation with 10d nails requires minimum 3" top plate thickness.
4. TC26 fastened to grouted concrete block with (8) - 3/4" x 2 1/4" Titen screws has a factored uplift resistance of 275 lb.



DESIGN

(800) 999-5099
strongtie.com

H/TSP

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_D = 1.15$)					
					D.Fir-L			S-P-F		
		To Rafters/Truss	To Plates	To Studs	Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(5) 8d x 1½"	(4) 8d	—	740	685	300	680	485	215
					3.29	3.05	1.33	3.02	2.16	0.96
SS H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	765	160	160
					3.58	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	160	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	285	615	125	180
					3.29	0.80	1.18	2.74	0.56	0.85
H6	16	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	670	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS H8 ^a	18	(5) 10d x 1½"	(5) 10d x 1½"	—	1120	—	—	1025	—	—
					4.98	—	—	4.66	—	—
SS H10A ^a	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	565	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.54	1.36
H10A-2	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1835	1275	430	1645	880	305
					8.16	5.67	1.91	7.32	3.91	1.36
H10S ^{7,8}	18	(8) 8d x 1½"	(8) 8d x 1½"	(8) 8d	1465	795	315	1040	565	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2½"	(6) 16d x 2½"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	[1] (12) 8d x 1½"	(13) 8d	—	2390	855	320	1805	610	230
		[2] (12) 8d x 1½"	(15) 8d	—	10.63	3.80	1.42	8.03	2.71	1.02
					2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
TSP	16	(9) 10d x 1½"	(6) 10d x 1½"	—	1295	440	—	920	310	—
					5.76	1.96	—	4.09	1.38	—
		(9) 10d x 1½"	(6) 10d	—	1560	440	—	1105	310	—
					6.94	1.96	—	4.92	1.38	—

- Factored resistances have been increased 15% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 596 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTIECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 8/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1½" nails into the top plates and (3) 8d x 1½" nails into the lowest three flange holes into the truss bottom chord is 495 lb. (2.20 kN).
- Nails: 16d x 2½" = 0.162" dia. x 2½" long, 10d = 0.148" dia. x 3" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long, 8d x 1½" = 0.131" dia. x 1½" long. See pp. 27–28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

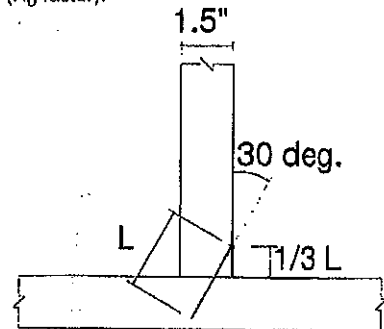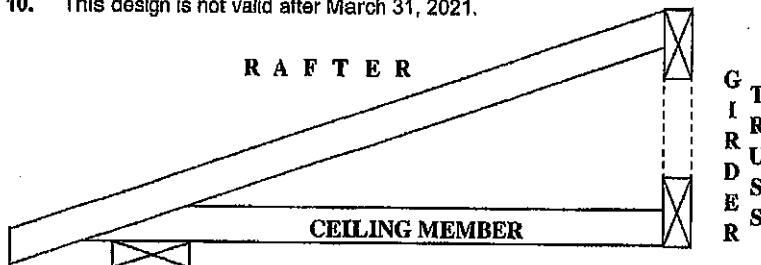

TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to wind or earthquake load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: G = 0.42(SPF), G = 0.49(D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

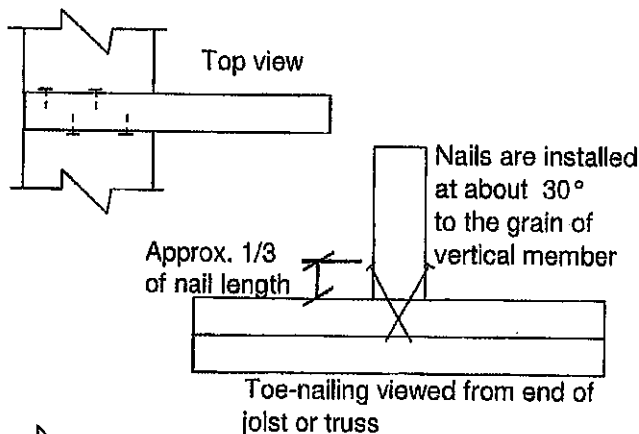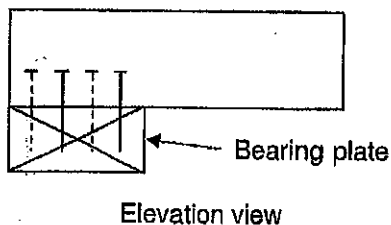

Toe-nailing on 2x4 Bearing Plate

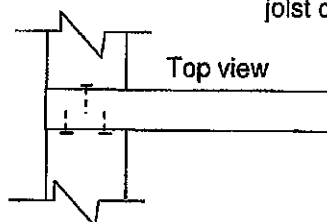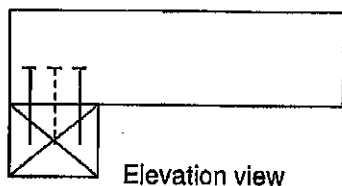

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7


PEO
Certificate No. 10889485




December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint, unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

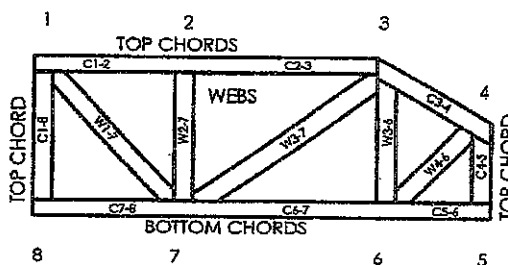

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L 10319-L 13270-L 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MIT-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected ovetop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

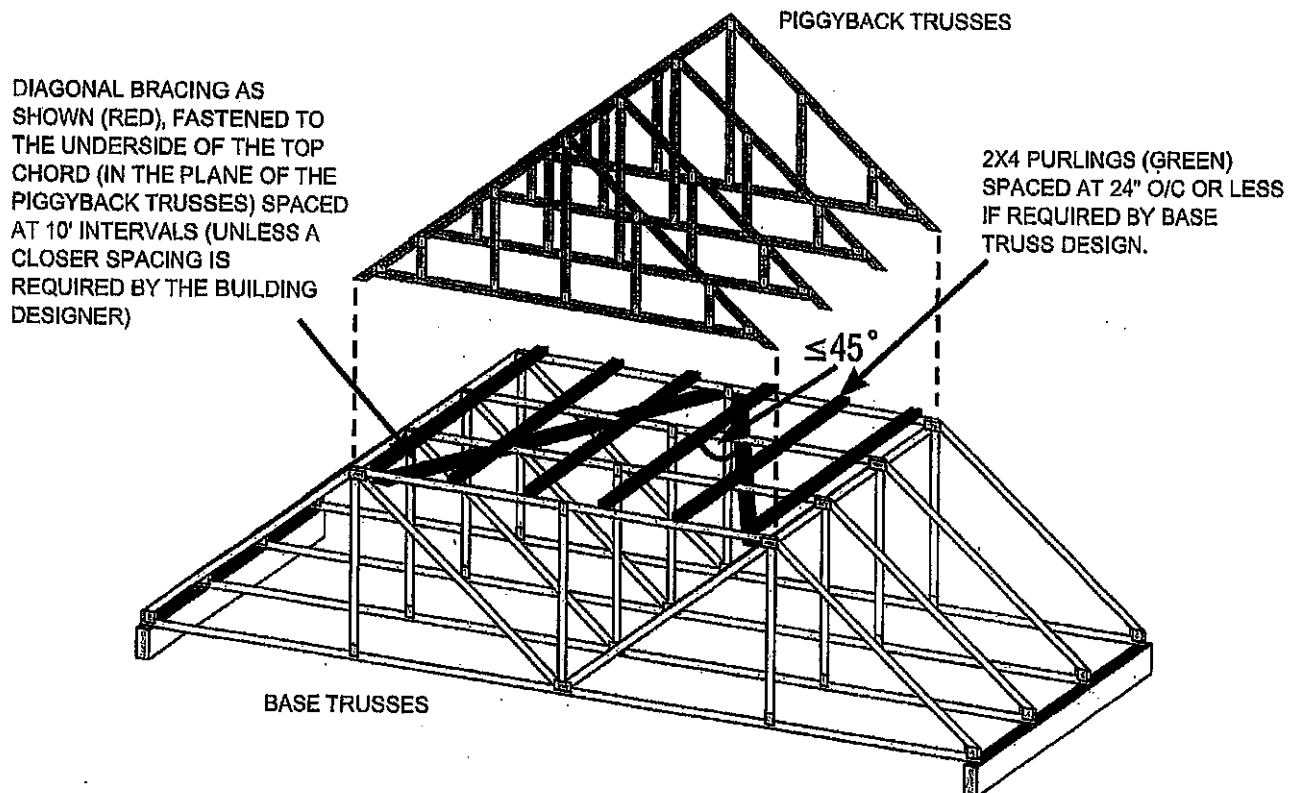


NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufacturer's responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet M117473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

7-1800215

Feb 09, 2018