


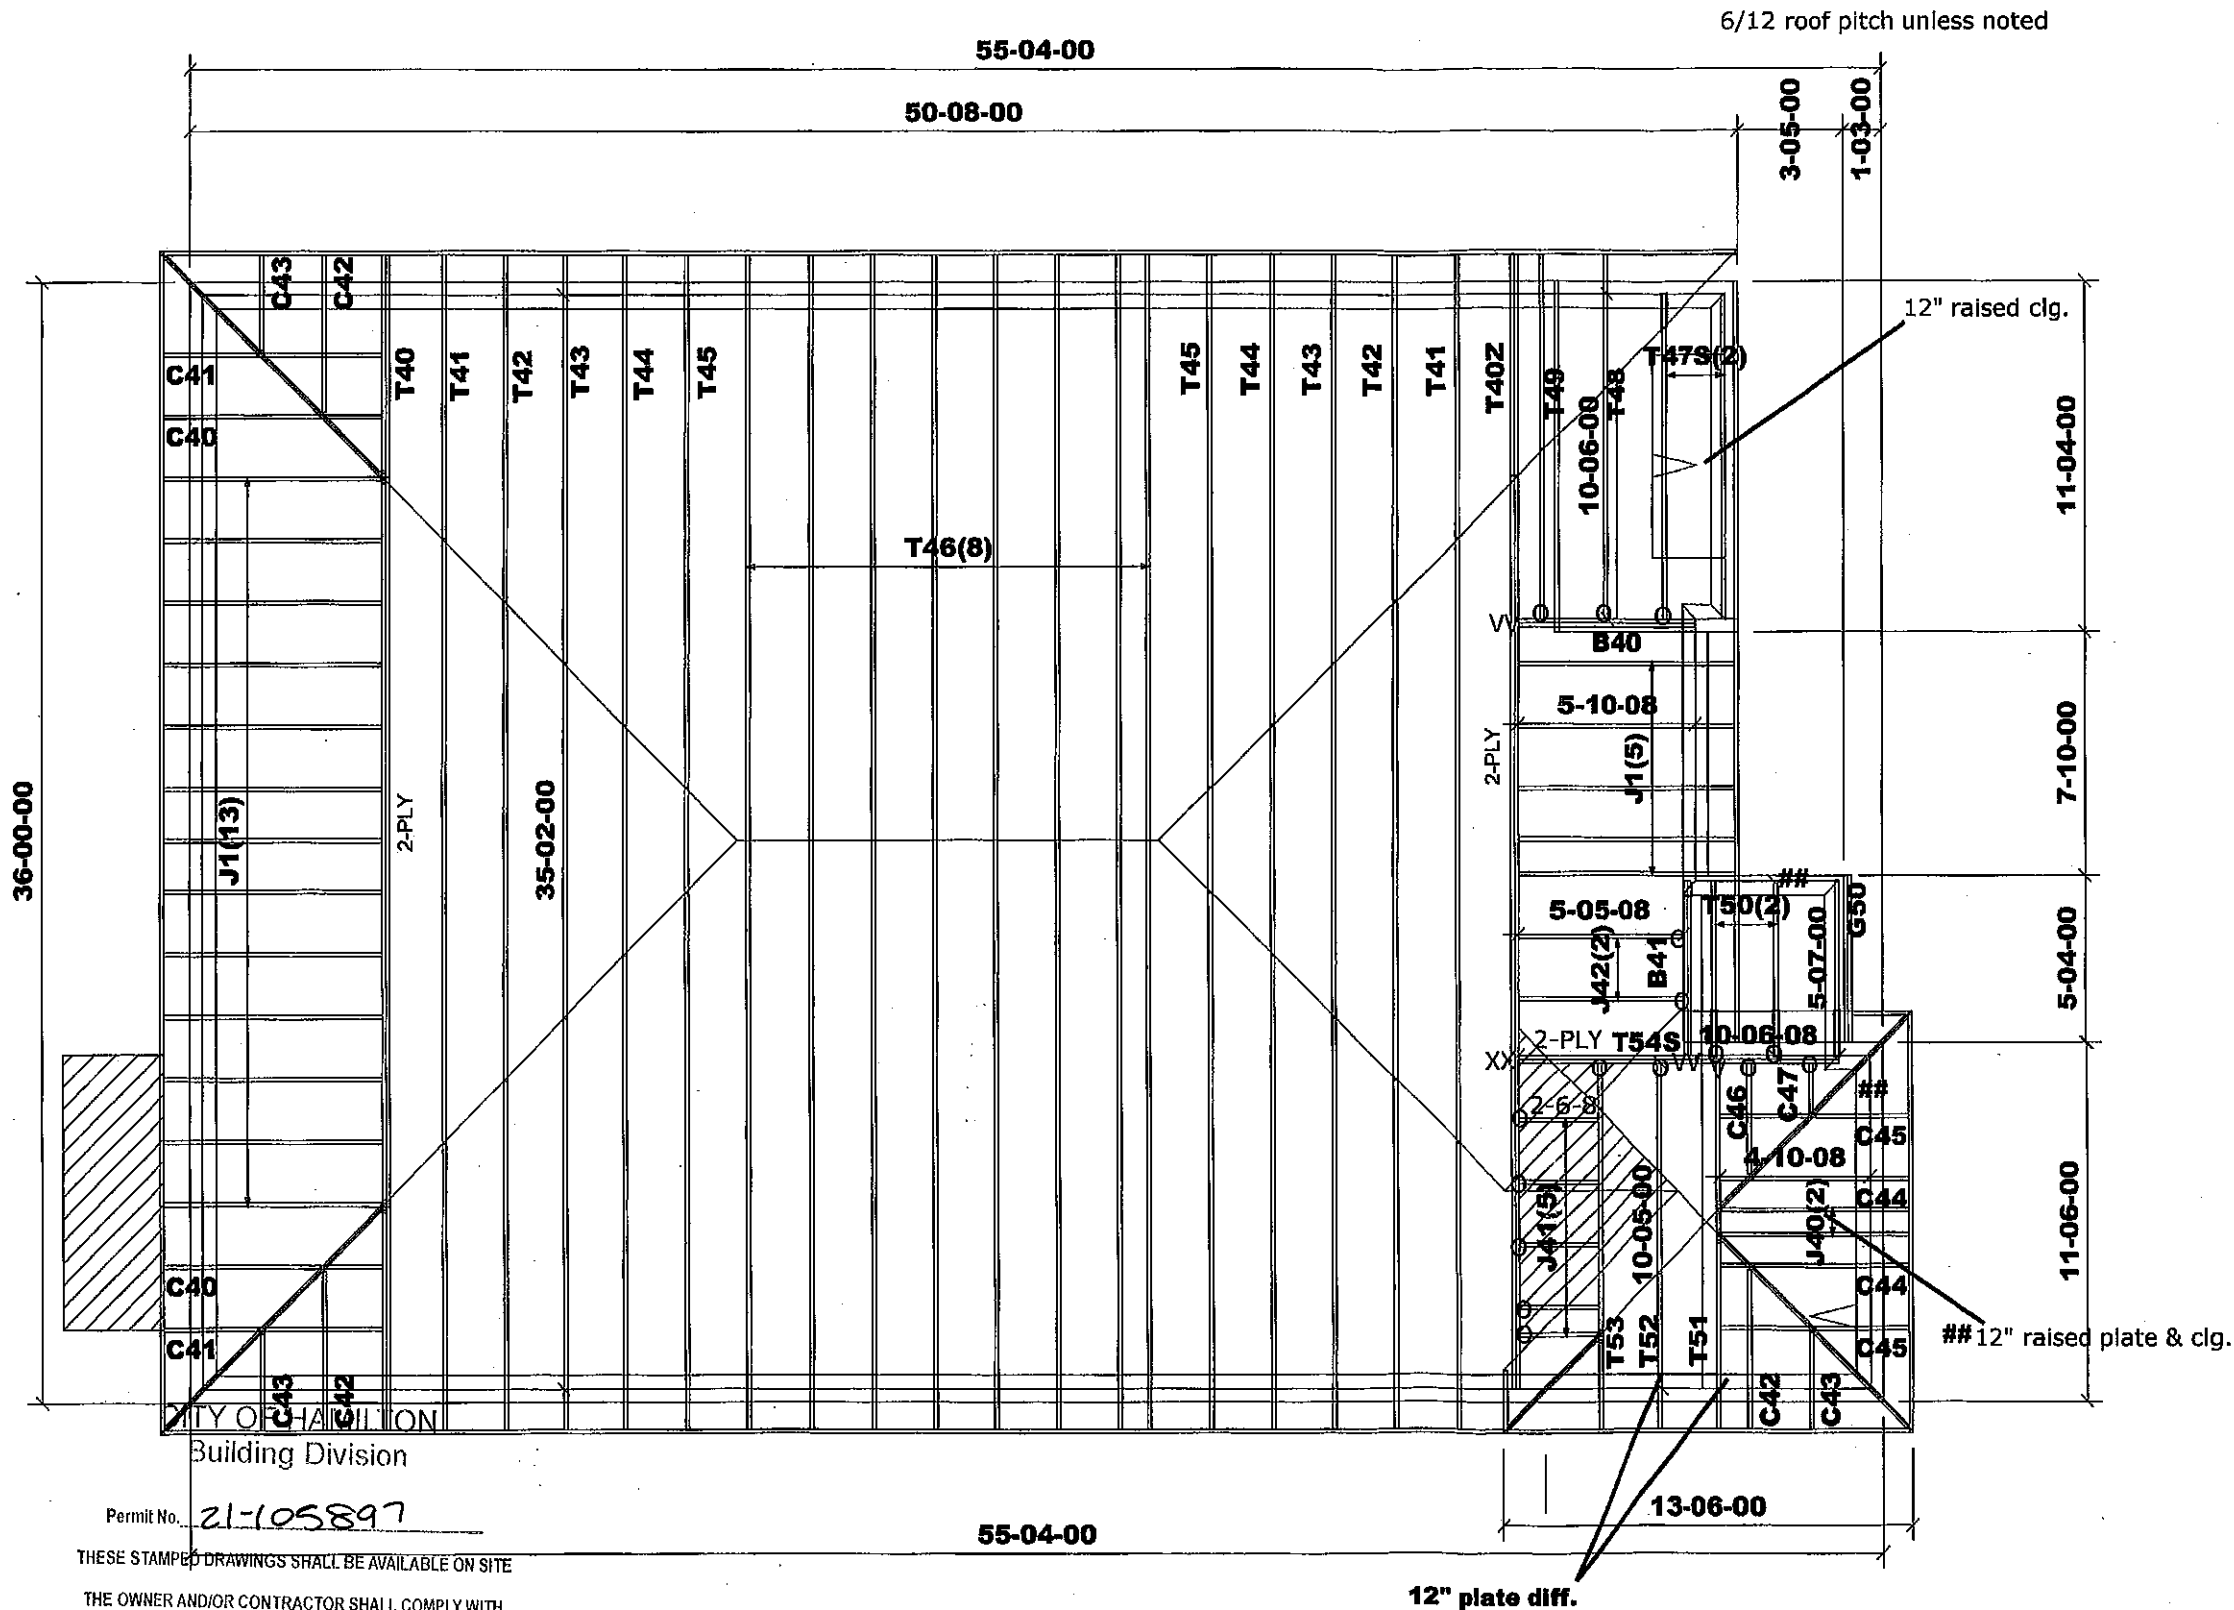

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)
LUS26-2-(VV)

BEAMS:
B40= B41 =
2 - 2x10 SPF #2

 DENOTES:
CONVENTIONAL
FRAMING



Job Track: 51225
Plan Log: 202419
Layout ID: 408224

Builder / Location: GREEN PARK HOMES / WATERDOWN
Project: RUSSELL GARDENS PH.3
Date: 2020-04-27 Sales: Mario DiCano Designer: JG

Model / Elevation: MOUNTAINASH 6/3- STD OR OPT.5 BR LOT 257

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

DELIVERY SHIPLIST




Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 6
 Lot #: 257
 Elevation: 3- STD OR OPT.5 BR

Job Track: 51225
 PlanLog: 202419
 Layout ID: 408224
 Ref #
 Page: 1 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T40 Hip Girder	6/12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	337.56 208.00		
	1 2-ply	T40Z Hip Girder	6/12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	337.56 208.00		
	2	T41 Hip	6/12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.99 174.00		
	2	T42 Hip	6/12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.12 174.67		
	2	T43 Hip	6/12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	289.07 179.67		
	2	T44 Hip	6/12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	290.73 183.33		
	2	T45 Hip	6/12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	301.67 191.33		
	8	T46 Common	6/12	35-02-00	9-11-08	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1178.98 726.33		
	2	T47S Roof Special	0/12	10-06-00	3-06-00	2 x 4		3-06-00 3-06-00	101.09 63.67		
	1	T48 Half Hip	6/12	10-06-00	2-08-00	2 x 4	1-03-08	1-02-00 2-08-00	39.94 26.87		
	1	T49 Half Hip	6/12	10-06-00	3-08-00	2 x 4	1-03-08	1-02-00 3-08-00	41.91 27.50		
	2	T50 Flat	0/12	5-07-00	3-00-00	2 x 4		3-00-00 3-00-00	45.54 30.00		
	1	G50 GABLE	0/12	5-07-00	3-00-00	2 x 4		3-00-00 3-00-00	22.18 15.00		
	1	T51 Hip Girder	6/12	10-05-00	3-07-04	2 x 4	1-03-08	1-02-00 1-03-08	43.52 29.67		

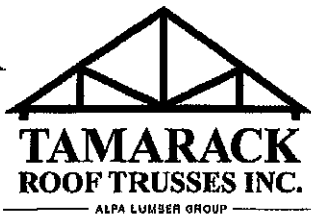


DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 6
 Lot #: 257
 Elevation: 3- STD OR OPT.5 BR

Job Track: 51225
 PlanLog: 202419
 Layout ID: 408224
 Ref #
 Page: 2 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T52 Hip	6 / 12	10-05-00	4-00-00	2 x 4	1-03-08	2-02-00 2-03-08	45.94 29.83		
	1	T53 Hip Girder	6 / 12	10-05-00	3-00-00	2 x 4	1-03-08	2-02-00 2-03-08	46.32 31.83		
	1 2-ply	T54S Roof Special Girder	0 / 12	10-06-08	2-02-00	2 x 4 2 x 6		1-02-00 2-02-00	97.7 64.33		
	18	J1 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	302.3 192.00		
	2	J40 Jack-Open	6 / 12	4-10-08	3-07-04	2 x 4	1-03-08	1-02-00 3-07-04	28.76 18.67		
	5	J41 Jack-Open	6 / 12	2-06-08	3-00-00	2 x 4		1-08-12 3-00-00	49.19 34.17		
	2	J42 Jack-Open	6 / 12	5-05-08	4-01-04	2 x 4		1-04-08 4-01-04	31.44 20.67		
	2	C40 Jack-Open	6 / 12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	28.26 17.33		
	2	C41 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	23.16 14.67		
	3	C42 Jack-Open	6 / 12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	28.71 18.00		
	3	C43 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	21.08 14.00		
	2	C44 Jack-Open	6 / 12	3-09-07	3-00-12	2 x 4	1-03-08 1-01-01	1-02-00 3-00-12	25.98 16.00		
	2	C45 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 3-01-01	1-02-00 2-00-12	20.88 13.33		
	1	C46 Jack-Open	6 / 12	1-07-08	3-00-12	2 x 4	1-10-15	1-03-08 2-01-04	7.46 5.33		

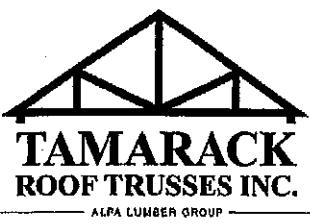 TAMARACK ROOF TRUSSES INC. ALFA LUMBER GROUP		DELIVERY SHIPLIST			
		Lumber Yard: TAMARACK LUMBER		Job Track: 51225	
Builder: GREEN PARK HOMES		PlanLog: 202419			
Project: RUSSELL GARDENS PH.3		Layout ID: 408224			
Location: WATERDOWN		Ref #			
Model: MOUNTAINASH 6		Page: 3 of 3			
Lot #: 257		Date: 04-27-2020			
Elevation: 3- STD OR OPT.5 BR		Designer:			
		Sales Rep: Mario DiCano			

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	C47 Jack-Open	6 /12	1-07-08	2-00-12	2 x 4		1-03-08 2-01-04	4.91 3.33		

TOTAL # TRUSS= 77 TOTAL BFT OF ALL TRUSSES= 2730.33 BFT. TOTAL WEIGHT OF ALL TRSSES 4346.93 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	HGUS26-2	
1	Hardware	LJS26DS	
14	Hardware	LUS24	
2	Hardware	LUS26-2	

TOTAL NUMBER OF
ITEMS= 18


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T1	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:00:04 2020 Page 1

ID:DMCubINV6TstFoe31v6l zns1l-Jm9J81AhZ122g2EEminZsEz3HTh7mEdCAUuvczMFI

Scale = 1:57.6

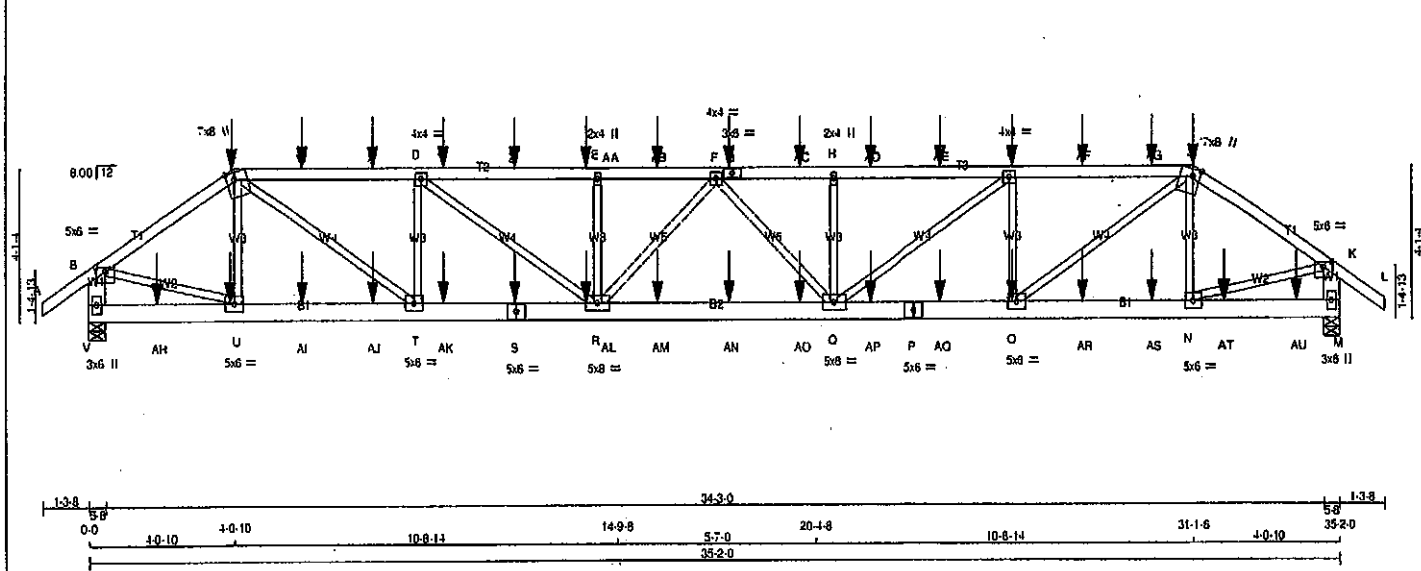

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY No.2	SPF			
C - G	2x4 DRY No.2	SPF			
G - J	2x4 DRY No.2	SPF			
J - L	2x4 DRY No.2	SPF			
V - B	2x6 DRY No.2	SPF			
M - K	2x6 DRY No.2	SPF			
V - S	2x6 DRY No.2	SPF			
S - P	2x6 DRY No.2	SPF			
P - M	2x6 DRY No.2	SPF			
ALL WEBS	2x3 DRY No.2	SPF			
EXCEPT					

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	SIDE(183.1)
C - G	12	SIDE(183.1)
G - J	12	SIDE(183.1)
J - L	12	SIDE(183.1)
V - B	12	TOP
M - K	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
V - S	12	SIDE(183.1)
S - P	12	SIDE(183.1)
P - M	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HOZ	UPLIFT
V	3393	0	0	5-8
M	3342	0	0	5-8
UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS		
JT	COMBINED	SNOW	LIVE	PERM. LIVE
V	2397	1585	0	0
M	2363	1555	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V. M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.11 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	MAX	CS1 (LC)	MAX. UNBRACED	WEBS	MAX. FACTORED	MAX	CS1 (LC)
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	FROM	TO	LENGTH	FR-TO	MEMB.	FORCE (LBS)	MAX	CS1 (LC)
A-B	0 35	-91.8	-91.8	0.07 (1)	10.00	U-C	-820	0	0.08 (1)	
B-C	-4024	0	-91.8	-91.8	0.22 (1)	4.55	C-T	0 3389	0.42 (1)	
C-W	-6074	0	-91.8	-91.8	0.53 (1)	3.51	T-D	-1846	0	0.23 (1)
W-X	-6074	0	-91.8	-91.8	0.53 (1)	3.51	D-I	-1889	0	0.24 (1)
X-D	-6074	0	-91.8	-91.8	0.53 (1)	3.51	Q-J	0 3425	0.42 (1)	
D-Y	-7423	0	-91.8	-91.8	0.63 (1)	3.11	N-U	-601	0	0.08 (1)
Y-Z	-7423	0	-91.8	-91.8	0.63 (1)	3.11	B-U	0 3437	0.43 (1)	
Z-AA	-7423	0	-91.8	-91.8	0.63 (1)	3.11	N-K	0 3371	0.42 (1)	
AA-E	-7423	0	-91.8	-91.8	0.63 (1)	3.11	Q-I	0 1704	0.21 (1)	
E-AB	-7423	0	-91.8	-91.8	0.35 (1)	3.38	D-R	0 1677	0.21 (1)	
AB-F	-7423	0	-91.8	-91.8	0.35 (1)	3.38	Q-H	-595	0	0.08 (1)
F-G	-7410	0	-91.8	-91.8	0.36 (1)	3.36	R-E	-594	0	0.08 (1)
G-AC	-7410	0	-91.8	-91.8	0.36 (1)	3.36	R-F	-285	0	0.06 (1)
AC-H	-7410	0	-91.8	-91.8	0.36 (1)	3.36	F-Q	-305	0	0.06 (1)
H-AD	-7410	0	-91.8	-91.8	0.61 (1)	3.14				
AD-AE	-7410	0	-91.8	-91.8	0.61 (1)	3.14				
AE-I	-7410	0	-91.8	-91.8	0.61 (1)	3.14				
I-AF	-6040	0	-91.8	-91.8	0.51 (1)	3.55				
AF-AG	-6040	0	-91.8	-91.8	0.51 (1)	3.55				
AG-J	-6040	0	-91.8	-91.8	0.51 (1)	3.55				
J-K	-3948	0	-91.8	-91.8	0.22 (1)	4.58				
K-L	0 35	-91.8	-91.8	0.07 (1)	10.00					
V-B	-3355	0	0.0	0.0	0.12 (1)	7.60				
M-K	-3298	0	0.0	0.0	0.12 (1)	7.64				

V-AH	0 0	-18.5	-18.5	0.04 (4)	10.00
AH-U	0 0	-18.5	-18.5	0.04 (4)	10.00
U-AI	0 3325	-18.5	-18.5	0.25 (1)	10.00
AI-AJ	0 3325	-18.5	-18.5	0.25 (1)	10.00
AJ-T	0 3325	-18.5	-18.5	0.25 (1)	10.00
T-AK	0 6074	-18.5	-18.5	0.45 (1)	10.00
AK-S	0 6074	-18.5	-18.5	0.45 (1)	10.00
S-AL	0 6074	-18.5	-18.5	0.45 (1)	10.00
AL-R	0 6074	-18.5	-18.5	0.45 (1)	10.00
R-AM	0 7613	-18.5	-18.5	0.57 (1)	10.00
AM-AN	0 7613	-18.5	-18.5	0.57 (1)	10.00
AN-O	0 7613	-18.5	-18.5	0.57 (1)	10.00
O-AP	0 6040	-18.5	-18.5	0.45 (1)	10.00
AP-P	0 6040	-18.5	-18.5	0.45 (1)	10.00
P-AQ	0 6040	-18.5	-18.5	0.45 (1)	10.00
AQ-O	0 6040	-18.5	-18.5	0.45 (1)	10.00
O-AR	0 3261	-18.5	-18.5	0.25 (1)	10.00

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***

GEOMETRY AND/OR BASIC LOADS CHANGED BY USER

LOADS WERE DERIVED FROM USER INPUT

NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L 360 (1.17)

CALCULATED VERT. DEFL.(LL) = L 999 (0.23)

ALLOWABLE DEFL.(TL) = L 360 (1.17)

CALCULATED VERT. DEFL.(TL) = L 970 (0.44)

CS1: TC=0.83/1.00 (D-E:1), BC=0.57/1.00 (Q-R:1), WB=0.43/1.00 (B-U:1), SS1=0.19/1.00 (Q-D:1)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (1) (INPUT = 0.80)

JSI METAL = 0.58 (1) (INPUT = 1.00)



Structural component only

DRWG# T-2007602 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T1	1	2	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:00:04 2020 Page 2

ID:DMCubINVR6TsFoe31v8l zns11-Jm8J91AhZl22a2EEemNZsEz3HTH7mEdCAUuvczMFll

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	6.0	1.50	3.00
C	TTWW+m	MT20	7.0	8.0	Edge	2.50
D, F, I						
D	TMWV-l	MT20	4.0	4.0		
E	TMWV-w	MT20	2.0	4.0		
G	TS-l	MT20	3.0	6.0		
H	TMWV-w	MT20	2.0	4.0		
J	TTWW+m	MT20	7.0	8.0	Edge	2.50
K	TMWV-p	MT20	5.0	6.0	1.50	3.00
M	BMV-l+p	MT20	3.0	6.0		
N, O, T, U						
N	BMWV-l	MT20	5.0	6.0		
P	BS-l	MT20	5.0	6.0		
Q	BMWVW-l	MT20	5.0	8.0		
R	BMWVW-l	MT20	5.0	8.0		
S	BS-l	MT20	5.0	6.0		
V	BMV-l+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING

TOTAL LOAD CASES: 14

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO			FR-TO		
AR-AS	0 3261	-18.5 -18.5	0.25 (1)	10.00			
AS-N	0 3261	-18.5 -18.5	0.25 (1)	10.00			
N-AT	0 0	-18.5 -18.5	0.04 (4)	10.00			
AT-AU	0 0	-18.5 -18.5	0.04 (4)	10.00			
AU-M	0 0	-18.5 -18.5	0.04 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-10	-48	-55	---	FRONT	VERT	DEAD	---	C1
C	4-0-10	-117	-117	---	FRONT	VERT	TOTAL	---	C1
C	4-0-10	-254	-254	---	FRONT	VERT	SNOW	---	C1
G	17-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
I	25-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
J	31-1-6	-48	-55	---	FRONT	VERT	DEAD	---	C1
J	31-1-6	-254	-254	---	FRONT	VERT	SNOW	---	C1
O	25-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
S	11-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
U	3-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
W	5-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	19-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	21-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	23-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	27-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AG	29-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AH	1-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AI	5-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AJ	7-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AK	9-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AL	13-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AM	15-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AN	17-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AO	19-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AP	21-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AQ	23-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AR	27-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AS	29-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AT	31-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AU	33-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007602 3/2


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T1Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:05 2020 Page 1

ID:DMCubINVR6TstFoe31v6I zns11-nyjhmNBKJcAvHCpQKTuoORWDOscNkApnRqDRR2zMFie

1-3.8 0.0 4-0-10 4-0-10 5-3-4 7-3-4 9-3-12 14-9-8 17-7-0 20-4-8 25-10-4 31-1-6 35-2-0 38-8-8
1-3.8 4-0-10 4-0-10 5-3-4 7-3-4 9-3-12 14-9-8 17-7-0 20-4-8 25-10-4 31-1-6 35-2-0 38-8-8
Scale = 1:57.6

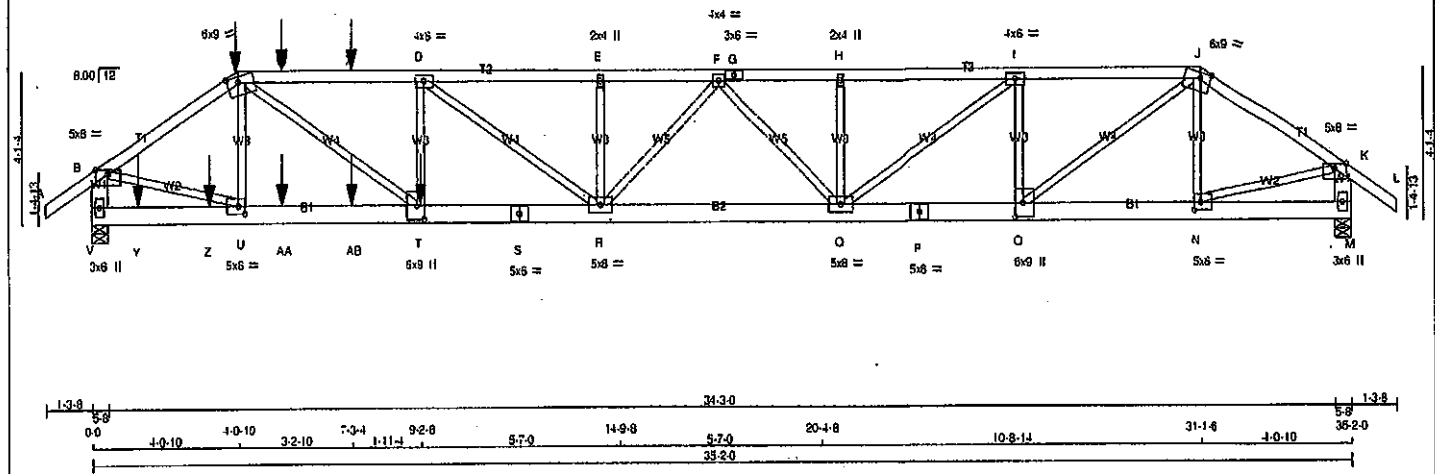

TOTAL WEIGHT = 2 X 181 = 362 lb

CHORDS	SIZE	DRY	LUMBER	DESCR
A - C	2x4	DRY	No.2	SPF
C - G	2x4	DRY	No.2	SPF
G - J	2x4	DRY	No.2	SPF
J - L	2x4	DRY	No.2	SPF
L - B	2x4	DRY	No.2	SPF
M - K	2x4	DRY	No.2	SPF
V - S	2x6	DRY	No.2	SPF
P - M	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	SIDE(61.0)
C - G	12	SIDE(61.0)
G - J	12	TOP
J - L	12	TOP
L - B	12	TOP
M - K	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
V - S	12	SIDE(183.1)
S - P	12	TOP
P - M	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	SIDE(385.4)
D - T	4	
I - O	4	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT 4215	0	0	5-8
V	HORZ 4215	0	0	5-8
M	VERT 2722	0	0	5-8

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
JT	COMBINED SNOW 1987	0	0	0
V	LIVE 2974	0	0	0
M	PERM. LIVE 1921	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.00 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)		
FR-TO		FROM TO			FR-TO				
A-B	0 35	-91.8	-91.8	0.07 (1)	10.00	U-C	-783	0 0.10 (1)	
B-C	-5115 0	-91.8	-91.8	0.28 (1)	4.07	C-T	0 4817	0.60 (1)	
C-W	-8135 0	-91.8	-91.8	0.84 (1)	3.00	T-D	622 0	0.08 (1)	
W-X	-8135 0	-91.8	-91.8	0.84 (1)	3.00	O-I	-1797- 0	0.23 (1)	
X-D	-8135 0	-91.8	-91.8	0.84 (1)	3.00	C-J	0 3211	0.40 (1)	
D-E	-8106 0	-91.8	-91.8	0.59 (1)	3.05	N-J	-512- 0	0.06 (1)	
E-F	-8106 0	-91.8	-91.8	0.52 (1)	3.28	B-U	0 4370	0.54 (1)	
F-G	-6928 0	-91.8	-91.8	0.28 (1)	3.57	A-K	0 2893	0.33 (1)	
G-H	-6928 0	-91.8	-91.8	0.28 (1)	3.57	O-I	0 2133	0.26 (1)	
H-I	-6928 0	-91.8	-91.8	0.45 (1)	3.42	D-H	-37 24	0.01 (1)	
I-J	-5210 0	-91.8	-91.8	0.34 (1)	3.99	O-H	-365 0	0.05 (1)	
J-K	-3153 0	-91.8	-91.8	0.19 (1)	5.04	R-E	-343 0	0.04 (1)	
K-L	0 35	-91.8	-91.8	0.07 (1)	10.00	R-F	0 692	0.09 (1)	
V-B	-4180 0	0.0	0.0	0.15 (1)	6.99	F-Q	-1081 0	0.23 (1)	
M-K	-2696 0	0.0	0.0	0.10 (1)	7.81				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-10	-49	-55	---	FRONT	VERT	DEAD	---	C1
T	4-0-10	-254	-254	---	FRONT	VERT	SNOW	---	C1
C	9-2-8	-2179	-2179	---	BACK	VERT	TOTAL	---	C1
W	5-3-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
X	7-3-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
Y	1-3-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
Z	3-3-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
AA	5-3-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
AB	7-3-4	-28	-28	---	BACK	VERT	TOTAL	---	C1

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.24")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/954 (0.44")

CSI: TG=0.64/1.00 (C-D); BC=0.61/1.00 (R-T); WB=0.60/1.00 (C-T); SS=0.17/1.00 (C-D)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (J) (INPUT = 0.90)

JSI METAL = 0.77 (P) (INPUT = 1.00)

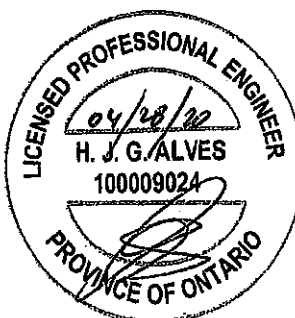

Structural component only
DWG# T-2007603

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T1Z	1	2	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:05 2020 Page 2

ID:DMCubINVR6TstF0e31v6I zns1I-nvIhMNBJKcAvHCpCKTupORWDoscNkAgnRqDRR2zMFle

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TTWW-m	MT20	6.0	9.0	1.75	3.50
D	TMWW-l	MT20	4.0	6.0		
E	TMW-w	MT20	2.0	4.0		
F	TMWW-l	MT20	4.0	4.0		
G	TS-l	MT20	3.0	8.0		
H	TMW-w	MT20	2.0	4.0		
I	TMWW-l	MT20	4.0	8.0		
J	TTWW-m	MT20	6.0	9.0	1.75	3.50
K	TMVW-p	MT20	5.0	8.0	Edge	
M	BMV-l-p	MT20	3.0	6.0		
N	BMWW-l	MT20	5.0	6.0	2.50	2.25
O	BMWW-l	MT20	6.0	9.0	4.50	2.50
P	BS-l	MT20	5.0	6.0		
Q	BMWW-l	MT20	5.0	8.0		
R	BMWW-l	MT20	5.0	8.0		
S	BS-l	MT20	5.0	6.0		
T	BMWW-l	MT20	8.0	9.0	4.50	2.50
U	BMWW-l	MT20	5.0	6.0	2.50	2.25
V	BMV-l-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

11 C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.





Structural component only
DWG# T-2007603 7/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DWG NO.
408222	T2	2	1	TRUSS DESC.		

Tamareck Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 08:00:06 2020 Page 1

ID:DMCubINVR6TsIFoe31v6I zns11-P8H4aCjX5wimvMOcuAP1x2LGGy5TgywUz7 UzMFId

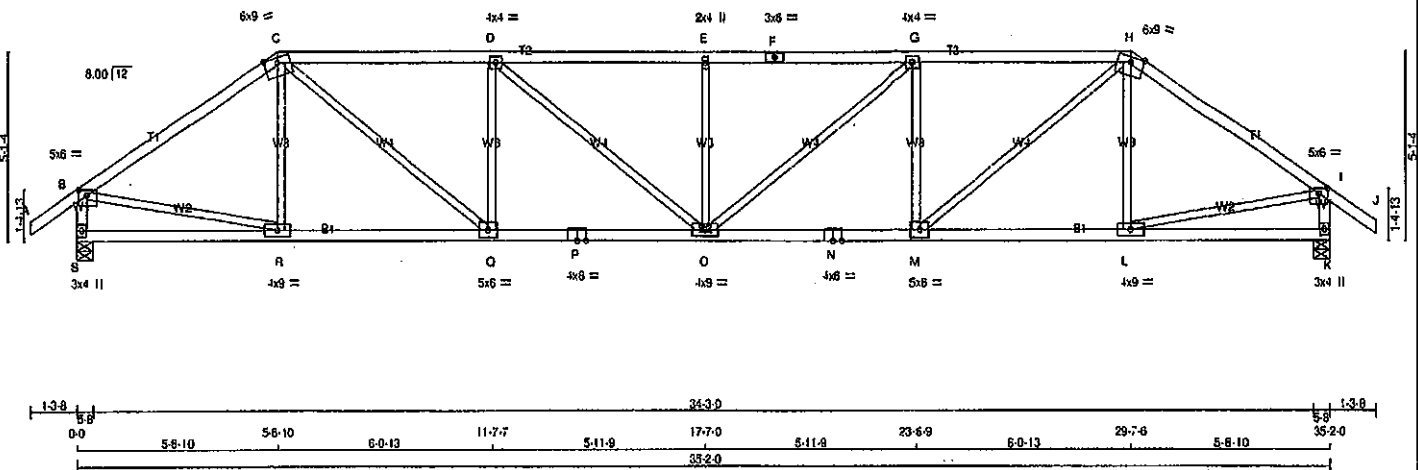

TOTAL WEIGHT = 2 X 140 = 280 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - J	2x4	DRY	No.2	SPF	
J - L	2x4	DRY	No.2	SPF	
L - N	2x4	DRY	No.2	SPF	
N - K	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMW-p	MT20	5.0	6.0	1.75	2.75
C	TTWW-na	MT20	6.0	9.0	Edge	
D	TMWW-i	MT20	4.0	4.0		
E	TMWW-w	MT20	2.0	4.0		
F	TS-i	MT20	3.0	6.0		
G	TMWW-i	MT20	4.0	4.0		
H	TTWW-m	MT20	6.0	9.0	Edge	
I	TMWW-p	MT20	5.0	6.0	1.75	2.75
K	BMV1-p	MT20	3.0	4.0		
L	BMWW-i	MT20	4.0	9.0		
M	BMWW-i	MT20	5.0	6.0		
N	BS-i	MT20	4.0	6.0		
O	BMWW-i	MT20	4.0	9.0		
P	BS-i	MT20	4.0	6.0		
Q	BMWW-i	MT20	5.0	6.0		
R	BMWW-i	MT20	4.0	9.0		
S	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING DESIGNER									
<u>BEARINGS</u>									
	FACTORED			MAXIMUM FACTORED			INPUT	REQD	
	GROSS REACTION			GROSS REACTION			BRG	BRG	
JT	VERT	HORZ		DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
S	2085	0		2085	0	0	5-8	5-8	
K	2085	0		2085	0	0	5-8	5-8	
<u>UNFACTORED REACTIONS</u>									
	1ST LCASE		MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
S	1488	970 : 0	0 : 0	0 : 0	0 : 0	488 : 0	0 : 0		
K	1488	970 : 0	0 : 0	0 : 0	0 : 0	488 : 0	0 : 0		

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1458	970.0	0.0	0.0	0.0	488.0	0.0
K	1458	970.0	0.0	0.0	0.0	488.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.97 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. (PLF)	CS (LC)	UNBRAC	MEMB.	FORCE (LBS)	MAX. (LBS)	CS (LC)
FR-TO		FROM	TO			FR-TO			
A-B	0 35	-91.8	-91.8	0.12 (1)	10.00	R-C	-243 10	0.09 (1)	
B-C	-2298 0	-91.8	-91.8	0.70 (1)	3.78	C-D	0 1670	0.38 (1)	
C-D	-3213 0	-91.8	-91.8	0.80 (1)	3.19	D-E	-929 0	0.38 (1)	
D-E	-3594 0	-91.8	-91.8	0.88 (1)	2.97	E-F	0 490	0.11 (1)	
E-F	-3594 0	-91.8	-91.8	0.88 (1)	2.97	F-G	-505 0	0.19 (1)	
F-G	-3594 0	-91.8	-91.8	0.88 (1)	2.97	G-H	0 490	0.11 (1)	
G-H	-3213 0	-91.8	-91.8	0.80 (1)	3.19	H-I	-929 0	0.38 (1)	
H-I	-2298 0	-91.8	-91.8	0.70 (1)	3.78	I-J	0 1670	0.38 (1)	
I-J	0 35	-91.8	-91.8	0.12 (1)	10.00	J-K	-243 10	0.09 (1)	
J-K	-2023 0	0.0	0.0	0.21 (1)	5.94	K-L	0 1943	0.44 (1)	
K-L	-2023 0	0.0	0.0	0.21 (1)	5.94	L-M	0 1943	0.44 (1)	
S-R	0 0	-18.5	-18.5	0.15 (4)	10.00				
R-Q	0 1903	-18.5	-18.5	0.39 (1)	10.00				
Q-P	0 3213	-18.5	-18.5	0.58 (1)	10.00				
P-O	0 3213	-18.5	-18.5	0.58 (1)	10.00				
O-N	0 3213	-18.5	-18.5	0.58 (1)	10.00				
N-M	0 3213	-18.5	-18.5	0.58 (1)	10.00				
M-L	0 1903	-18.5	-18.5	0.39 (1)	10.00				
L-K	0 0	-18.5	-18.5	0.15 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CS: TC=0.88/1.00 (D-E:1), BC=0.58/1.00 (M-O:1), WB=0.44/1.00 (I-L:1), SS=0.28/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE (GRIP/DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (I) (INPUT = 0.90)
JSI METAL= 0.74 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007604




JSI GRIP= 0.80 (M) (INPUT = 0.90)
JSI METAL= 0.84 (P) (INPUT = 1.00)



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T4	2	1	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 26 09:00:07 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-jLrSn2CZsDQdXWpSuwGTsbZlgK2C5T4u8iYwWzMFic

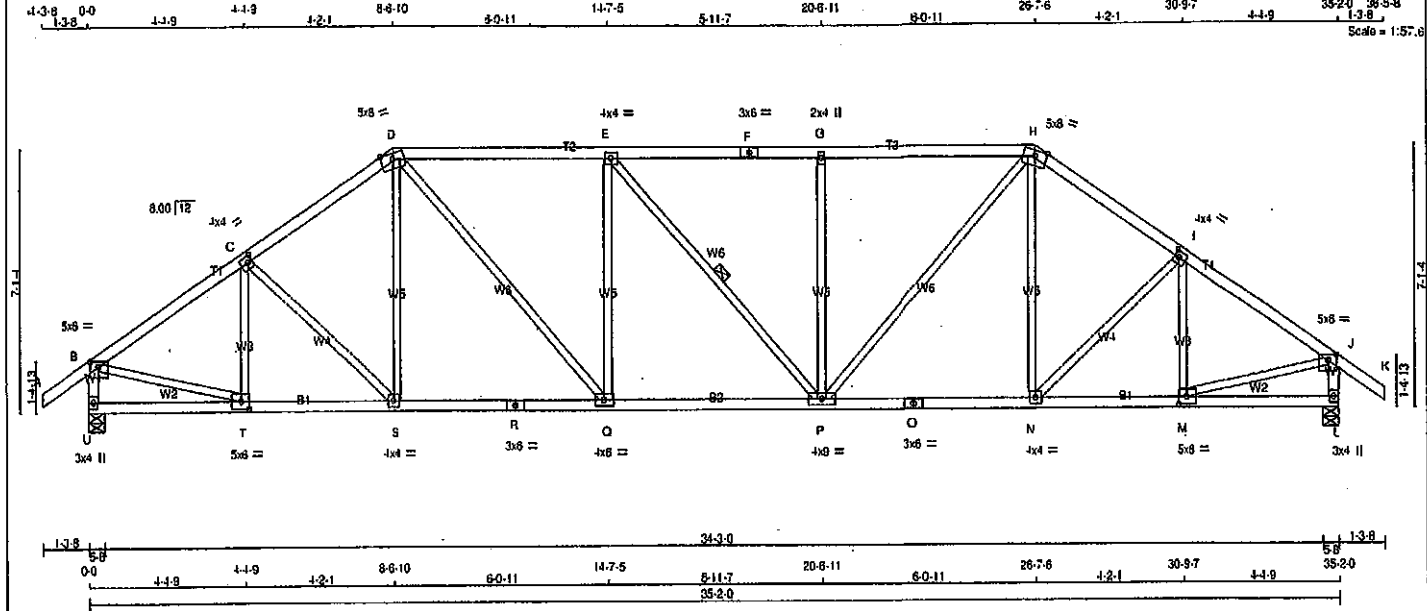

TOTAL WEIGHT = 2 X 155 = 309 lb

LUMBER			N. L. G. A. RULES		
CHORDS	SIZE	LUMBER	DESCR.	SPF	
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - K	2x4	DRY	No.2	SPF	
U - B	2x4	DRY	No.2	SPF	
U - J	2x4	DRY	No.2	SPF	
U - R	2x4	DRY	No.2	SPF	
U - O	2x4	DRY	No.2	SPF	
O - L	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
DRY: SEASONED LUMBER.					

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	6.0	1.75	2.75
C TMVW-l	MT20	4.0	4.0	2.00	1.50
D TTWW-m	MT20	5.0	8.0	Edge	
E TMVW-l	MT20	4.0	4.0		
F TS-l	MT20	3.0	6.0		
G TMVW-w	MT20	2.0	4.0		
H TTWW-m	MT20	5.0	8.0	Edge	
I TMVW-l	MT20	4.0	4.0	2.00	1.50
J TMVW-p	MT20	5.0	6.0	1.75	2.75
L BMV-l-p	MT20	3.0	4.0		
M BMVW-l	MT20	5.0	8.0	2.50	2.75
N BMVW-l	MT20	4.0	4.0		
O BS-l	MT20	3.0	6.0		
P BMVW-l	MT20	4.0	9.0		
Q BMVW-l	MT20	4.0	6.0		
R BS-l	MT20	3.0	6.0		
S BMVW-l	MT20	4.0	4.0		
T BMVW-l	MT20	5.0	6.0	2.50	2.75
U BMV-l-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
		FACTORED	MAXIMUM FACTORED	INPUT	REQD
		GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
U	2065	0	2065	0	0
L	2065	0	2065	0	0

UNFACTORED REACTIONS					
		1ST CASE	MAX-MIN	COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
U	1458	970	0	0	0
L	1458	970	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1.2 LENGTH OF E-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

CHORDS					
		MAX. FACTORED	FACTORED	MAX. FACTORED	
		FORCE	VERT. LOAD	MAX. FACTORED	
		(LBS)	(PLF)	CS1 (LC)	UNBRAC
					LENGTH
FR-TO			FROM	TO	FR-TO
A-B	0	35	-91.8	-91.8	10.00
B-C	-2289	0	-91.8	-91.8	0.37 (1)
C-D	-2254	0	-91.8	-91.8	0.36 (1)
D-E	-2485	0	-91.8	-91.8	0.84 (1)
E-F	-2483	0	-91.8	-91.8	0.84 (1)
F-G	-2483	0	-91.8	-91.8	0.84 (1)
G-H	-2483	0	-91.8	-91.8	0.83 (1)
H-I	-2254	0	-91.8	-91.8	0.36 (1)
I-J	-2269	0	-91.8	-91.8	0.37 (1)
J-K	0	35	-91.8	-91.8	0.12 (1)
U-B	-2027	0	0.0	0.0	0.21 (1)
L-J	-2026	0	0.0	0.0	0.21 (1)
U-T	0	0	-18.5	-18.5	0.08 (4)
T-S	0	1908	-18.5	-18.5	0.37 (1)
S-R	0	1853	-18.5	-18.5	0.36 (1)
R-Q	0	1853	-18.5	-18.5	0.36 (1)
Q-P	0	2485	-18.5	-18.5	0.47 (1)
P-O	0	1854	-18.5	-18.5	0.36 (1)
O-N	0	1854	-18.5	-18.5	0.36 (1)
N-M	0	1908	-18.5	-18.5	0.37 (1)
M-L	0	0	-18.5	-18.5	0.08 (4)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CS1: TC=0.64/1.00 (D-E:1), BC=0.47/1.00 (P-Q:1), WB=0.52/1.00 (E-G:1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 L5 BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.90 (D) (INPUT = 0.90)
JSI METAL= 0.62 (O) (INPUT = 1.00)



Structural component only
DWG# T-2007606



PLATES (feet is in inches)		W	LEN	Y	X
J	T TYPE	PLATES			
B	TMMW-p	MT20	5.0	6.0	1.75 2.75
C	TMMW-i	MT20	4.0	4.0	2.00 1.50
D	TMMW-m	MT20	5.0	6.0	2.25 1.75
E	TMMW-w	MT20	2.0	4.0	
F	TMMW-m	MT20	5.0	6.0	2.25 1.75
G	TMMW-i	MT20	4.0	4.0	2.00 1.50
H	TMMW-p	MT20	5.0	6.0	1.75 2.75
I	BMV1+p	MT20	3.0	4.0	
J	BMWV-i	MT20	5.0	6.0	2.50 2.75
K	BMWV-w	MT20	4.0	4.0	
L	BS-1	MT20	3.0	6.0	
M	BMWVW-i	MT20	4.0	9.0	
N	BS-1	MT20	3.0	6.0	
O	BMWV-w	MT20	4.0	4.0	
P	BMWV-i	MT20	5.0	6.0	2.50 2.75
Q	BMV1+p	MT20	3.0	4.0	

JT	FACTORED		MAXIMUM FACTORED		INPUT	REGRD
	GROSS REACTION		GROSS REACTION		BRG	IN-SX
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
R	2085	0	2085	0	0	5-8
J	2085	0	2085	0	0	5-8

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1458	970 0	0 0	0 0	0 0	488 0	0 0
J	1458	970 0	0 0	0 0	0 0	488 0	0 0

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT.
MAX UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

TOTAL LOAD CASES: 14)

CHORDS					WEBS				
MAX. FACTORED		FACTORED			MAX. FACTORED				
MEMB.	FORCE	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FORCE	MAX	
	(LBS)	(PLF)	CSI (LC)	UNBRAC			(LBS)	CSI (LC)	
FR-TO		FROM TO		LENGTH	FR-TO				
A-B	0 35	-91.8	-91.8	0.12 (1)	10.00	Q-C	-321 0	0.11 (1)	
B-C	-2317 0	-91.8	-91.8	0.38 (1)	4.16	P-D	-218 0	0.18 (1)	
C-D	-2185 0	-91.8	-91.8	0.37 (1)	4.28	C-P	0 266	0.06 (1)	
D-E	-2274 0	-91.8	-91.8	0.81 (1)	3.47	D-N	0 691	0.11 (1)	
E-F	-2274 0	-91.8	-91.8	0.37 (1)	3.47	M-N	-851 0	0.35 (1)	
F-G	-2185 0	-91.8	-91.8	0.37 (1)	4.28	N-F	0 691	0.11 (1)	
G-H	-2317 0	-91.8	-91.8	0.38 (1)	4.16	L-F	0 266	0.06 (1)	
H-I	0 35	-91.8	-91.8	0.12 (1)	10.00	L-G	-218 0	0.18 (1)	
R-B	-2022 0	0.0	0.0	0.21 (1)	5.94	K-G	-321 0	0.11 (1)	
J-H	-2022 0	0.0	0.0	0.21 (1)	5.94	B-O	0 1955	0.45 (1)	
						K-H	0 1955	0.45 (1)	
R-Q	0 0	-18.5	-18.5	0.10 (4)	10.00				
Q-P	0 1953	-18.5	-18.5	0.40 (1)	10.00				
P-O	0 1794	-18.5	-18.5	0.41 (1)	10.00				
Q-N	0 1794	-18.5	-18.5	0.41 (1)	10.00				
N-M	0 1794	-18.5	-18.5	0.41 (1)	10.00				
M-L	0 1794	-18.5	-18.5	0.41 (1)	10.00				
L-K	0 1953	-18.5	-18.5	0.40 (1)	10.00				
L-J	0 0	-18.5	-18.5	0.10 (4)	10.00				

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	OL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018 , OBC 2012 , ABC 2019
- PART 8 OF OBC 2012 (2019 AMENOMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF
LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.17")
CALCULATED VERT. DEFL.(LL)= L 999 (0.11")
ALLOWABLE DEFL.(TL)= L/360 (1.17")
CALCULATED VERT. DEFL.(TL)= L 999 (0.22")

CSI: TC=0.81, 1.00 (E-F:1), 8C=0.41, 1.00 (L-N:1),
WR=0.45, 1.00 (H-K:1), SSI=0.34, 1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMB=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	818	354	1667	788	1987	1650

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (H) (INPUT = 0.80)
JSI METAL= 0.64 (M) (INPUT = 1.00)




Structural component only
DWG# T-2007607

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T6	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:00:09 2020 Page 1
ID:DMCubINVR6TstF0a31v6l_znsII-fjyCCKEpOrgLmp6BZlykZHgXkU0ng01MLSBapzMPia

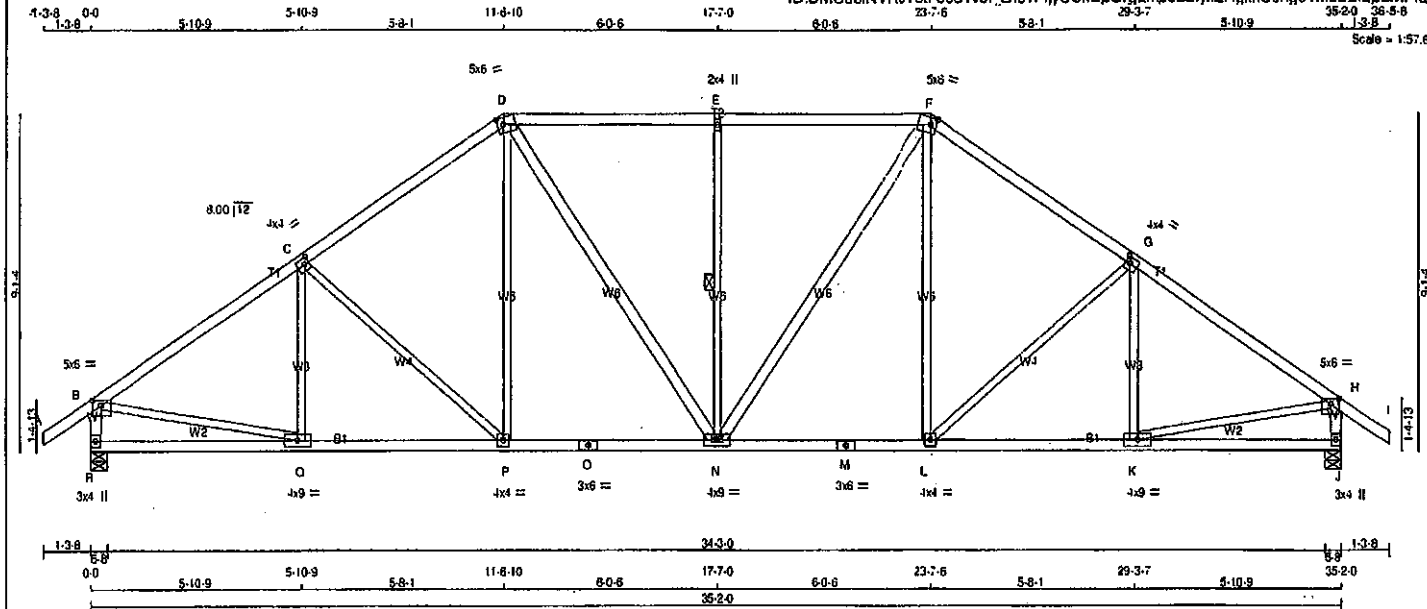

TOTAL WEIGHT = 2 X 165 = 329 lb
(M/F)

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2
H - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED	GROSS REACTION	MAXIMUM FACTORED	INPUT	RECORD		
	VERT	HORZ	DOWN	UP	BRG	BRG	
JT	2065	0	2065	0	5-8	5-8	
R	2065	0	2065	0	5-8	5-8	
J	2065	0	2065	0	5-8	5-8	

UNFACTORED REACTIONS							
	1ST LOSE	MAX. MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERMALIVE	WIND	DEAD	SOIL
JT	1458	970	0	0	0	488	0
R	1458	970	0	0	0	488	0
J	1458	970	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATEROALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING			
TOTAL LOAD CASES: (4)			
CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)
FR-TO			
A-B	0 35	-91.8 -91.8 0.12 (1)	10.00
B-C	-2348 0	-91.8 -91.8 0.52 (1)	3.99
C-D	-2095 0	-91.8 -91.8 0.48 (1)	4.22
D-E	-1985 0	-91.8 -91.8 0.49 (1)	4.26
E-F	-1985 0	-91.8 -91.8 0.49 (1)	4.26
F-G	-2095 0	-91.8 -91.8 0.48 (1)	4.22
G-H	-2348 0	-91.8 -91.8 0.52 (1)	3.99
H-I	0 35	-91.8 -91.8 0.12 (1)	10.00
R-B	-2018 0	0.0 0.0 0.21 (1)	5.94
J-H	-2018 0	0.0 0.0 0.21 (1)	5.94
R-Q	0 0	-18.5 -18.5 0.14 (4)	10.00
Q-P	0 1980	-18.5 -18.5 0.39 (1)	10.00
P-O	0 1716	-18.5 -18.5 0.34 (1)	10.00
O-N	0 1716	-18.5 -18.5 0.34 (1)	10.00
N-M	0 1716	-18.5 -18.5 0.34 (1)	10.00
M-L	0 1716	-18.5 -18.5 0.34 (1)	10.00
L-K	0 1981	-18.5 -18.5 0.39 (1)	10.00
K-J	0 0	-18.5 -18.5 0.14 (4)	10.00
WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. FACTORED FORCE (LBS)
Q-C	-249 11	0.11 (1)	
C-P	-368 0	0.42 (1)	
P-D	0 341	0.08 (1)	
D-N	0 477	0.08 (1)	
N-E	-678 0	0.37 (1)	
N-F	0 477	0.08 (1)	
L-F	0 341	0.08 (1)	
L-G	-358 0	0.42 (1)	
K-G	-249 11	0.11 (1)	
B-Q	0 2014	0.48 (1)	
K-H	0 2014	0.48 (1)	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GIC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.19")

CSI: TC=0.52/1.00 (G-H:1), BC=0.39/1.00 (K-L:1), WB=0.45/1.00 (H-K:1), SI=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
- MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.87 (H) INPUT = 0.90
JSI METAL= 0.58 (M) INPUT = 1.00



Structural component only
DWG# T-2007608

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T7	6	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:00:10 2020 Page 1
 ID:DMCubINVR6TstF0e31v6I_zns1I-7wWaP4FR98oCOzh070Uz5VD4qtMXPTGWA8xC7FzMFIZ
 35-20 36-5-8 1-3-8 Scale = 1:58.9

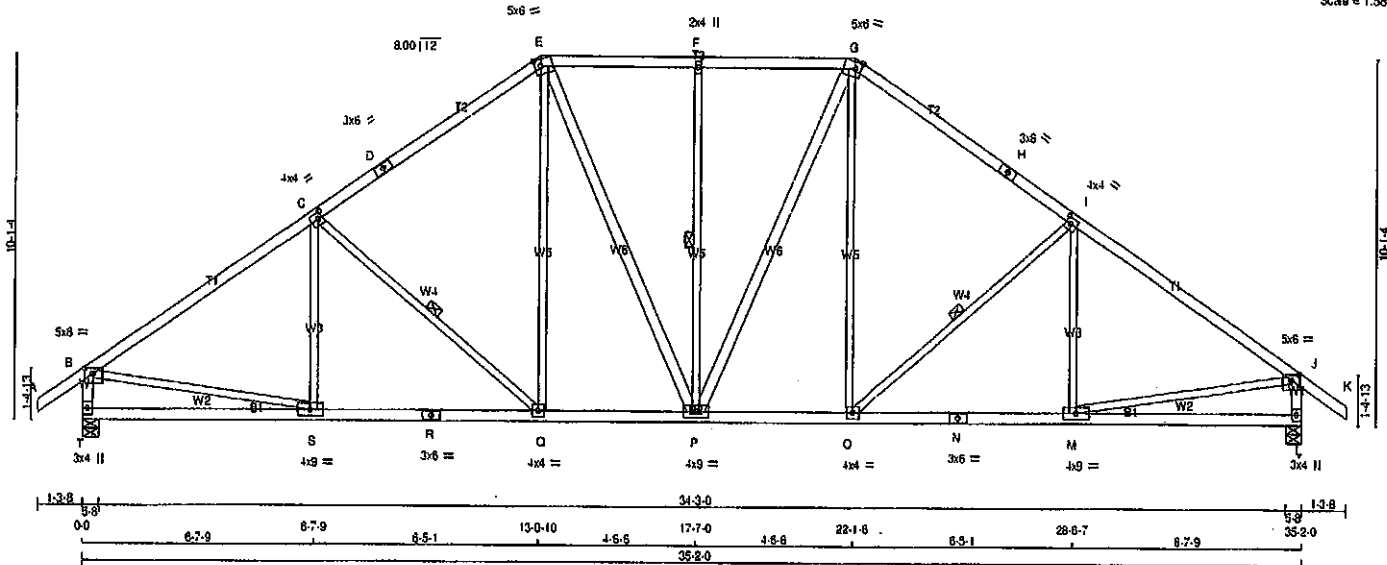

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - J	2x4	DRY	No.2
J - R	2x4	DRY	No.2
R - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
E - P	2x4	DRY	No.2
P - G	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	6.0	1.75	2.75
C TMVW-t	MT20	4.0	4.0	2.00	1.50
D TS-t	MT20	3.0	6.0		
E TTWW-m	MT20	5.0	6.0	2.25	2.00
F TMVW-w	MT20	2.0	4.0		
G TTWW-m	MT20	5.0	6.0	2.25	2.00
H TS-t	MT20	3.0	6.0		
I TMVW-p	MT20	4.0	4.0	2.00	1.50
J TMVW-p	MT20	5.0	6.0	1.75	2.75
L BMV1+p	MT20	3.0	4.0		
M BMVW-t	MT20	4.0	9.0		
N BS-t	MT20	3.0	6.0		
O BMVW-t	MT20	4.0	4.0		
P BMVW-t	MT20	4.0	9.0		
Q BMVW-t	MT20	4.0	4.0		
R BS-t	MT20	3.0	6.0		
S BMVW-t	MT20	4.0	9.0		
T BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS									
FACTORED				MAXIMUM FACTORED		INPUT		RECORD	
GROSS REACTION				GROSS REACTION		BRG		BRG	
JT	VERT	HORZ		DOWN	HORZ	UPLIFT	IN-SX		IN-SX
T	2065	0		2065	0	0	5-8		5-8
L	2065	0		2065	0	0	5-8		5-8

UNFACTORED REACTIONS		1ST CASE		MAX. MIN. COMPONENT REACTIONS		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	DEAD	SOIL
T	1458	970	0	0	0	0	0	488	0
L	1458	970	0	0	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.77 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1:2 LENGTH OF C-Q, F-P, I-Q.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
 TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 35	-91.8 -91.8	0.12 (1)	10.00	S-C	-189 46	0.10 (1)
B-C	-2358 0	-91.8 -91.8	0.89 (1)	3.77	C-D	-484 0	0.24 (1)
C-D	-1996 0	-91.8 -91.8	0.82 (1)	4.11	Q-E	0 415	0.09 (1)
D-E	-1996 0	-91.8 -91.8	0.82 (1)	4.11	E-P	0 315	0.05 (1)
E-F	-1761 0	-91.8 -91.8	0.27 (1)	4.77	P-F	-502 0	0.35 (1)
F-G	-1761 0	-91.8 -91.8	0.27 (1)	4.77	P-G	0 315	0.05 (1)
G-H	-1996 0	-91.8 -91.8	0.82 (1)	4.11	O-G	0 415	0.09 (1)
H-I	-1996 0	-91.8 -91.8	0.82 (1)	4.11	O-I	-484 0	0.24 (1)
I-J	-2358 0	-91.8 -91.8	0.89 (1)	3.77	M-I	-189 46	0.10 (1)
J-K	0 35	-91.8 -91.8	0.12 (1)	10.00	B-S	0 2021	0.45 (1)
T-B	-2014 0	0.0 0.0	0.21 (1)	5.85	M-J	0 2021	0.45 (1)
L-J	-2014 0	0.0 0.0	0.21 (1)	5.85			
T-S	0 0	-18.5 -18.5	0.19 (4)	10.00			
S-R	0 1995	-18.5 -18.5	0.42 (1)	10.00			
R-Q	0 1995	-18.5 -18.5	0.42 (1)	10.00			
Q-P	0 1629	-18.5 -18.5	0.32 (1)	10.00			
P-O	0 1629	-18.5 -18.5	0.32 (1)	10.00			
O-N	0 1995	-18.5 -18.5	0.42 (1)	10.00			
N-M	0 1995	-18.5 -18.5	0.42 (1)	10.00			
M-L	0 0	-18.5 -18.5	0.19 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.18")

CSI: TC=0.69/1.00 (I-J:1), BC=0.42/1.00 (M-O:1), WB=0.45/1.00 (J-M:1), SS=0.24/1.00 (K-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR SECTION (PSI)	(PLI)	(PLI)
MAX MIN MAX MIN MAX MIN			
MT20	618	354	1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (I) (INPUT = 0.80)
 JSI METAL = 0.87 (I) (INPUT = 1.00)




Structural component only
 DWG# T-2007809

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T8	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 08:00:10 2020 Page 1

ID:DMCubINVR6TslFoe31v8l_zns1l-7wWvP4FR8BoCOzhO70Uz5VD1gtM2PTGWa8x7FzMFIZ

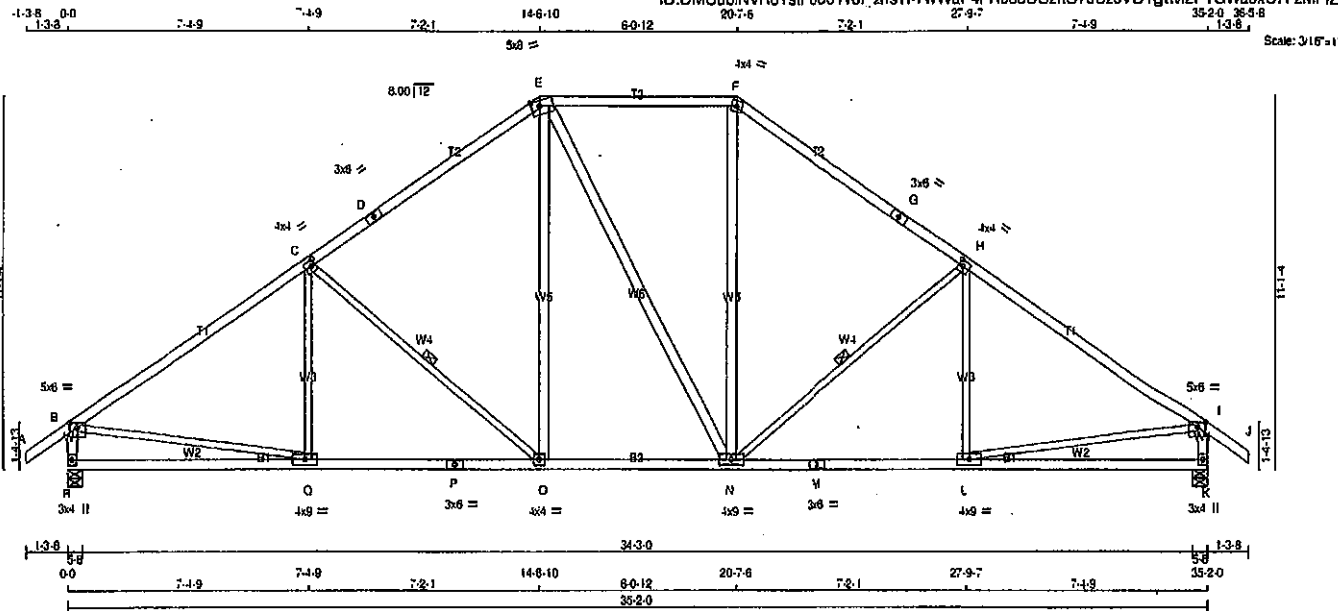

TOTAL WEIGHT = 2 X 166 = 333 lb

CHORDS	SIZE	DRY	NO.2
A - D	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - J	2x4	DRY	No.2
J - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - N	2x4	DRY	No.2
N - P	2x4	DRY	No.2
P - Q	2x4	DRY	No.2
Q - R	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
O - E	2x4	DRY	No.2
E - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (Table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	2.75
C	TMVW-l	MT20	4.0	4.0	2.00	1.50
D	TS-l	MT20	3.0	6.0		
E	TTWV-m	MT20	5.0	8.0	2.00	3.00
F	TTW-m	MT20	4.0	4.0		
G	TS-l	MT20	3.0	6.0		
H	TMVW-l	MT20	4.0	4.0	2.00	1.50
I	TMVW-p	MT20	5.0	8.0	1.75	2.75
K	BMV-l-p	MT20	3.0	4.0		
L	BMVW-l	MT20	4.0	9.0		
M	BS-l	MT20	3.0	6.0		
N	BMVW-l	MT20	4.0	9.0		
O	BMVW-l	MT20	4.0	4.0		
P	BS-l	MT20	3.0	6.0		
Q	BMVW-l	MT20	4.0	9.0		
R	BMV-l-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED	GROSS REACTION	MAXIMUM FACTORED	INPUT	REQD
	VERT	HORIZ	DOWN	HORIZ	UPLIFT
JT	2085	0	2085	0	0
R	2085	0	2085	0	0
K	2085	0	2085	0	0

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1458	970-0	0-0	0-0	0-0	488-0	0-0
K	1458	970-0	0-0	0-0	0-0	488-0	0-0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.45 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-O, H-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. UNBRACED LENGTH (FT)
FR-TO				FR-TO			
A-B	0 35	-91.8 -91.8 0.12 (1)	10.00	Q-C	-140 78	0.09 (1)	
B-C	-2357 0	-91.8 -91.8 0.89 (1)	3.45	C-O	-604 0	0.38 (1)	
C-D	-1888 0	-91.8 -91.8 0.78 (1)	3.91	O-E	0 499	0.08 (1)	
D-E	-1888 0	-91.8 -91.8 0.78 (1)	3.91	E-N	0 0	0.00 (1)	
E-F	-1538 0	-91.8 -91.8 0.47 (1)	4.74	N-F	0 500	0.08 (1)	
F-G	-1888 0	-91.8 -91.8 0.78 (1)	3.91	N-H	-604 0	0.38 (1)	
G-H	-1888 0	-91.8 -91.8 0.78 (1)	3.91	H-H	-140 75	0.09 (1)	
H-I	-2357 0	-91.8 -91.8 0.89 (1)	3.45	B-Q	0 2020	0.45 (1)	
I-J	0 35	-91.8 -91.8 0.12 (1)	10.00	L-I	0 2019	0.45 (1)	
R-B	-2009 0	0.0 0.0 0.21 (1)	5.95				
K-I	-2009 0	0.0 0.0 0.21 (1)	5.95				
R-Q	0 0	-18.5 -18.5 0.25 (4)	10.00				
Q-P	0 1888	-18.5 -18.5 0.45 (1)	10.00				
P-O	0 1888	-18.5 -18.5 0.45 (1)	10.00				
O-N	0 1538	-18.5 -18.5 0.33 (1)	10.00				
N-M	0 1888	-18.5 -18.5 0.45 (1)	10.00				
M-L	0 1888	-18.5 -18.5 0.45 (1)	10.00				
L-K	0 0	-18.5 -18.5 0.24 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
CALCULATED VERT. DEFL.(LL) = L/999 (0.09)
ALLOWABLE DEFL.(TL) = L/360 (1.17)
CALCULATED VERT. DEFL.(TL) = L/999 (0.20)

CSI: TC=0.89/1.00 (B-C:1), BC=0.45/1.00 (O-Q:1), WB=0.45/1.00 (B-Q:1), SSI=0.27/1.00 (H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1857
	788	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (F) INPUT = 0.90
JSI METAL= 0.68 (F) INPUT = 1.00



Structural component only
DWG# T-2007610

JOB NAME 408222	TRUSS NAME IT9	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:00:11 2020 Page 1	
ID:DMCubINVR8TslFoe31v6l_zns1l-b64yQGG4wSx377Gah?CeimKBHhB8ztbmgmizMFIY				Scale = 1:4.4	

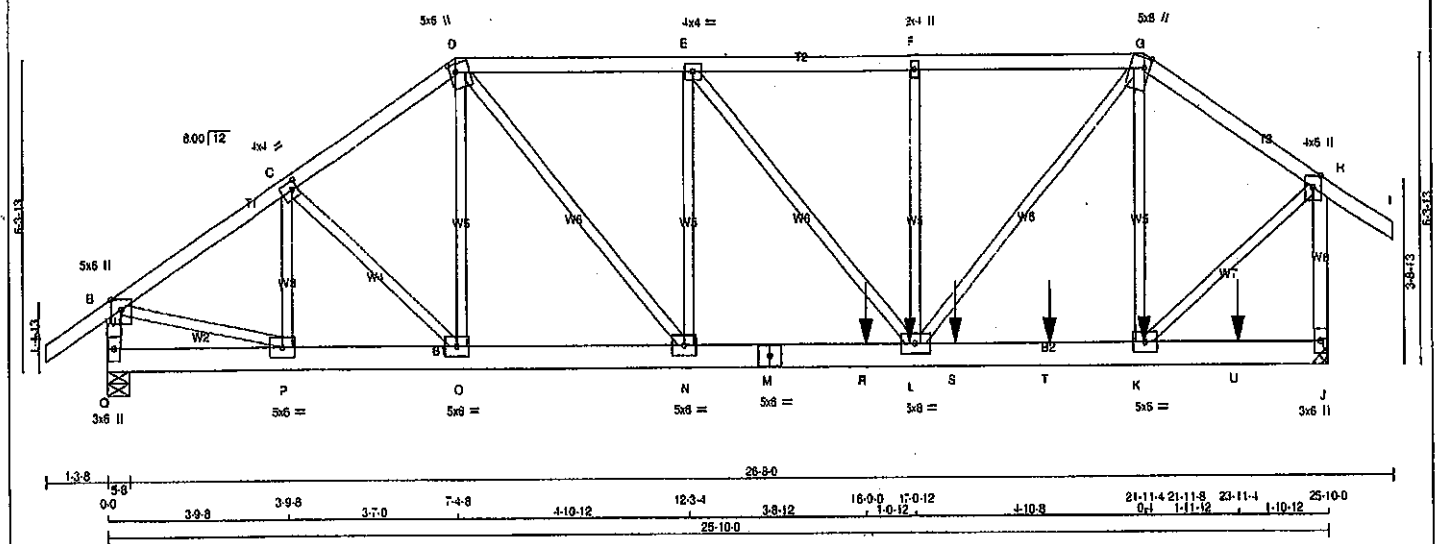

TOTAL WEIGHT = 2 X 136 = 271 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - G	2x4	DRY No.2	SPF
G - I	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
Q - M	2x6	DRY No.2	SPF
M - J	2x6	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS	#ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS			
A - D	1	12	TOP
D - G	1	12	TOP
G - I	1	12	TOP
I - H	1	12	TOP
H - J	1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS			
Q - M	2	12	TOP
M - J	2	12	SIDE (183.1)
WEBS : (0.122"x3") SPIRAL NAILS			
2x3	1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	HORZ	UPLIFT	IN-SX
Q 2236	0	2236	0
J 3067	0	3067	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 4-0.

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS						
JT COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
Q 1575	1085	0	0	0	510	0	0
J 2157	1479	0	0	0	678	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.97 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (FT)
FR-TO			
A-B	0 35	-91.8 -91.8 0.07 (1)	10.00
B-C	-2484 0	-91.8 -91.8 0.13 (1)	5.82
C-D	-2571 0	-91.8 -91.8 0.13 (1)	5.83
D-E	-3030 0	-91.8 -91.8 0.20 (1)	5.11
E-F	-3235 0	-91.8 -91.8 0.21 (1)	4.97
F-G	-3235 0	-91.8 -91.8 0.20 (1)	4.99
G-H	-2123 0	-91.8 -91.8 0.15 (1)	5.81
H-I	0 35	-91.8 -91.8 0.07 (1)	10.00
I-J	-2188 0	0.0 0.0 0.12 (1)	7.53
J-H	-2962 0	0.0 0.0 0.33 (1)	6.70
WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	
P-C	-503 0	0.06 (1)	
C-O	0 70	0.01 (1)	
O-D	-2 60	0.01 (1)	
D-N	0 1433	0.18 (1)	
N-E	-738 0	0.22 (1)	
E-L	0 327	0.04 (1)	
L-F	-169 0	0.14 (1)	
L-G	0 2339	0.29 (1)	
K-G	-995 0	0.30 (1)	
B-P	0 2137	0.28 (1)	
K-H	0 2299	0.28 (1)	

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
K	21-11-4	-187	-187	---	FRONT	VERT	TOTAL	---
L	16-11-4	-187	-187	---	FRONT	VERT	TOTAL	---
R	16-0-0	-1259	-1259	---	FRONT	VERT	TOTAL	---
S	17-11-4	-187	-187	---	FRONT	VERT	TOTAL	---
T	19-11-4	-187	-187	---	FRONT	VERT	TOTAL	---
U	23-11-4	-195	-195	---	FRONT	VERT	TOTAL	---

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.8	PSF
DL	= 6.0	PSF	
BOT CH.	LL	= 0.0	PSF
DL	= 7.4	PSF	
TOTAL LOAD	= 39.0	PSF	

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.88")
CALCULATED VERT. DEFL. (LL) = L/999 (0.06")
ALLOWABLE DEFL. (TL) = L/360 (0.88")
CALCULATED VERT. DEFL. (TL) = L/999 (0.12")

CSI: TC=0.33/1.00 (H-J:1), BC=0.45/1.00 (L-N:1), WB=0.30/1.00 (G-K:1), SSI=0.35/1.00 (L-N:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1867

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.81 (H) (INPUT = 0.90)
JSI METAL = 0.53 (H) (INPUT = 1.00)



Structural component only
DWG# T-2007611 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRAWG NO.
408222	T9	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:11 2020 Page 2
ID:DMCubINVR6TslFoe31v6l zns1l-b64ydcQ4wSx377Qahj?CeimKBHhB8zIomgmizMFiy

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	Edge	
C	TMWW-l	MT20	4.0	4.0	2.00	1.50
D	TTWW+m	MT20	5.0	6.0	2.00	1.50
E	TMWW-l	MT20	4.0	4.0		
F	TMW+w	MT20	2.0	4.0		
G	TTWW+m	MT20	5.0	6.0	2.50	1.50
H	TMVW+p	MT20	4.0	6.0	Edge	
J	BMV1+p	MT20	3.0	6.0		
K, N, O, P						
K	BMWW-l	MT20	5.0	6.0		
L	BMWWW-l	MT20	5.0	6.0		
M	BS-l	MT20	5.0	6.0		
Q	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.




Structural component only
DWG# T-2007611

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T11A	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 28 2019 MITek Industries, Inc. Tue Apr 28 09:00:12 2020 Page 1

ID:DMCubINVR6TstFoe31v6l zns11-4leLqmGihm3wdHmERWRRAwIXHh2P(N5p2QQJB6zMFIX

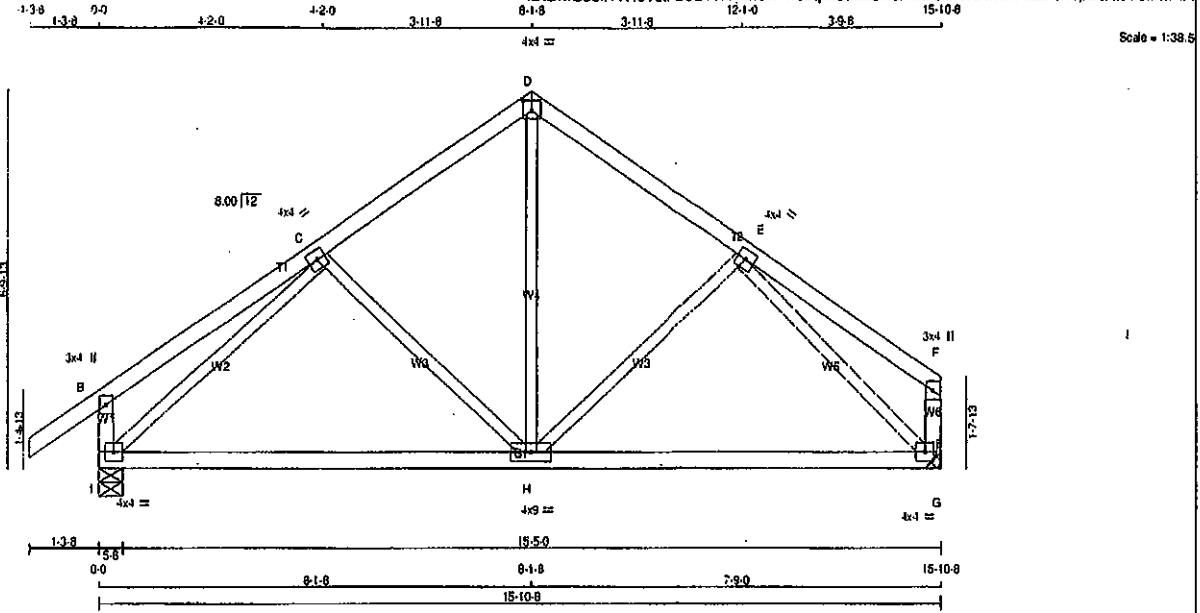

TOTAL WEIGHT = 2 X 66 = 133 lb [M/F]

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR.
A - D	2x4	DRY	No.2		SPF
D - F	2x4	DRY	No.2		SPF
I - G	2x4	DRY	No.2		SPF
G - F	2x4	DRY	No.2		SPF
I - G	2x4	DRY	No.2		SPF
ALL WEBS	2x3	DRY	No.2		SPF
EXCEPT					
DRY; SEASONED LUMBER.					

DRY: SEASONED LUMBER.

PLATES (table in in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWV-1	MT20	4.0	4.0		
D	TTW-p	MT20	4.0	4.0	2.25	2.00
E	TMWV-1	MT20	4.0	4.0		
F	TMV+p	MT20	3.0	4.0		
G	BMVW-1	MT20	4.0	4.0		
H	BMVWV-1	MT20	4.0	9.0		
I	BMVW-1	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER							
BEARINGS							
JT	FACTORED	GROSS REACTION	DOWN	MAXIMUM FACTORED	GROSS REACTION	UP	RECORD
JT	VERT	0	0	0	0	0	0
I	1001	0	1001	0	0	5.8	5.8
G	875	0	875	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	706	476	0	0	0	229	0
G	619	406	0	0	0	213	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC1)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 35	-91.8	-91.8	10.09	C-H	-228 0	0.12 (1)
B-C	0 24	-91.8	-91.8	10.09	H-D	0 449	0.10 (1)
C-D	-891 0	-91.8	-91.8	8.25	H-E	-168 0	0.09 (1)
D-E	-889 0	-91.8	-91.8	8.25	I-C	-988 0	0.50 (1)
E-F	0 24	-91.8	-91.8	10.09	E-G	-971 0	0.44 (1)
I-B	-289 0	0.0	0.0	7.81			
G-F	-125 0	0.0	0.0	0.01 (1)			
I-H	0 722	-18.5	-18.5	0.39 (4)			
H-G	0 677	-18.5	-18.5	0.39 (4)			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010. NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.53")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.53")
CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CSI: TC=0.24-1.00 (B-C:1), BC=0.39-1.00 (H-I:4), WB=0.50-1.00 (C-I:1), SS=0.15-1.00 (C-D:1)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MT20 618 354 1667 788 1987 1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.84 (E) (INPUT = 0.90)
JSI METAL= 0.35 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007613

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T11S	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:00:13 2020 Page 1
ID:DMCubiNVR6TstFoe31v6I zns11-YVC26HKS3BnFRQz081gJ7reK5PdcqyG49SjzMF1W

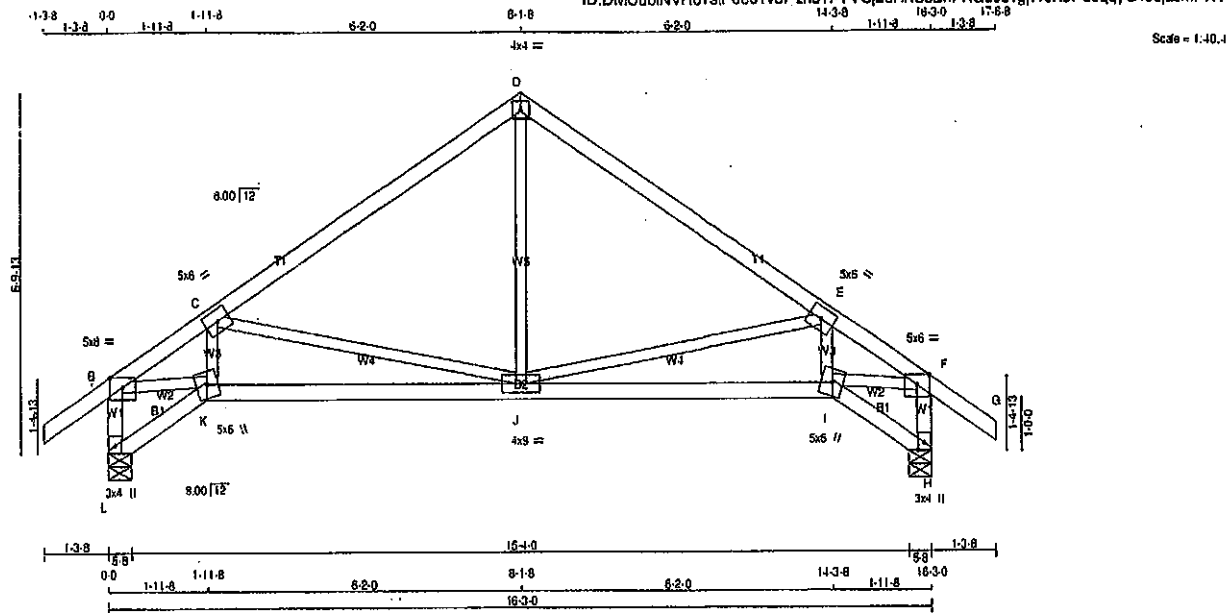

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
L - B	2x4	DRY	No.2
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

PLATES (table in inches)			
JT TYPE	PLATES	W	LEN Y X
B TMVW-p	MT20	5.0	6.0 Edge
C TMWW-I	MT20	5.0	6.0
D TTW-p	MT20	4.0	4.0 2.25 2.00
E TMWW-I	MT20	5.0	6.0
F TMVW-p	MT20	5.0	6.0 Edge
H BMV1-p	MT20	3.0	4.0 Edge
I BMWW-I	MT20	5.0	6.0
J BMWW-I	MT20	4.0	9.0
K BMWW-I	MT20	5.0	6.0
L BMV1-p	MT20	3.0	4.0 Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
L	1022	0	1022	0	5-8
H	1022	0	1022	0	5-8

UNFACTORED REACTIONS							
	1ST LCASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
L	720	488.0	0.0	0.0	0.0	234.0	0.0
H	720	488.0	0.0	0.0	0.0	234.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.97 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MEMB.	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	FACTORED	VERT. LOAD	LC1	MAX	MAX.
FR-TO		FORCE (LBS)		FROM TO		CS1 (LC)		UNBRAC LENGTH		FR-TO		FORCE (LBS)	
L-B	-1004	0	0.0	0.0	0.11	(1)	7.80	B-K	0	1321	0.30	(1)	0.02
A-B	0	35	-91.8	-91.8	0.12	(1)	10.00	K-C	0	55	0.02	(4)	0.48
B-C	-1508	0	-91.8	-91.8	0.33	(1)	4.97	C-J	-859	0	0.48	(1)	0.10
C-D	-841	0	-91.8	-91.8	0.41	(1)	6.08	J-E	0	444	0.47	(1)	0.02
D-E	-841	0	-91.8	-91.8	0.42	(1)	6.07	E-F	-861	0	0.47	(1)	0.02
E-F	-1510	0	-91.8	-91.8	0.33	(1)	4.97	F-G	0	58	0.02	(4)	0.30
F-G	0	35	-91.8	-91.8	0.12	(1)	10.00	G-H	0	1323	0.30	(1)	0.02
H-F	-1004	0	0.0	0.0	0.11	(1)	7.80						
L-K	0	0	-18.5	-18.5	0.02	(4)	10.00						
K-J	0	1319	-18.5	-18.5	0.33	(1)	10.00						
J-I	0	1320	-18.5	-18.5	0.33	(1)	10.00						
I-H	0	0	-18.5	-18.5	0.02	(4)	10.00						

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC2010, NBC2015

THIS DESIGN COMPLES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.54")
CALCULATED VERT. DEFL.(TL) = L/999 (0.08")

CS1: TC=0.42/1.00 (D-E:1), BC=0.33/1.00 (J-I:1), WB=0.47/1.00 (E-J:1), SS=0.21/1.00 (D-E:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (I) (INPUT = 0.90)
JSI METAL = 0.47 (K) (INPUT = 1.00)




Structural component only
DWG# T-2007614

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T12S	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:00:14 2020 Page 1

ID:DMCubINVR6TstFoe31v6I zns11-0hm5FSlyDNJda?9MsYvGLOuJVqYLOs6VkvQG0zMF1V

Scale = 1:27.5

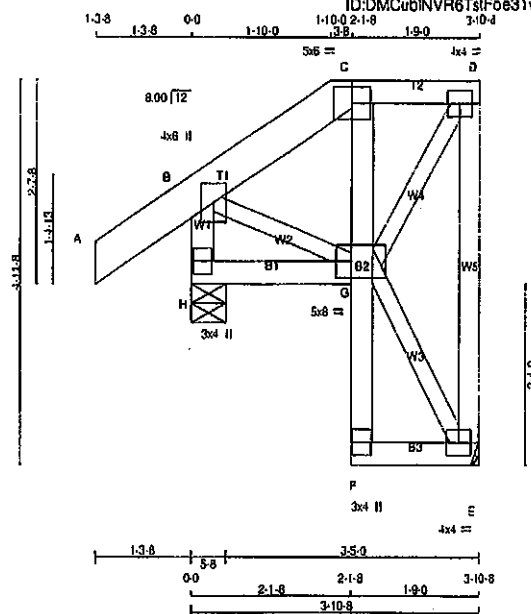

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x8	DRY	No.2
C - D	2x4	DRY	No.2
E - D	2x4	DRY	No.2
H - B	2x4	DRY	No.2
H - G	2x4	DRY	No.2
F - C	2x4	DRY	No.2
F - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	6.0	
C	TTV-m	MT20	5.0	6.0	
D	TMVW-l	MT20	4.0	4.0	
E	BMVW1-l	MT20	4.0	4.0	
F	BMV+p	MT20	3.0	4.0	
G	BMVWW1-l	MT20	5.0	8.0	2.50 2.50
H	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
E	214	0	214	0
H	344	0	344	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

1ST CASE	MAX. MIN.	COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	151	99	0	0	0	52	0
H	241	172	0	0	0	69	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: 15)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED		MEMB.	MAX. FACTORED	FACTORED	
	FORCE	VERT. LOAD	LC1		FORCE	MAX	
	(LBS)	(PLF)	CS1 (LC)		(LBS)	CS1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 36	-91.8 -91.8	0.07 (5)	10.00	G-D	0 139	0.03 (1)
B-C	-105 0	-91.8 -91.8	0.03 (1)	6.25	B-G	0 96	0.02 (1)
C-D	-79 0	-91.8 -91.8	0.05 (1)	6.25	G-E	-3 0	0.00 (1)
E-D	-196 0	0.0 0.0	0.08 (1)	7.81			
H-B	-323 0	0.0 0.0	0.03 (1)	7.81			
H-G	0 0	-18.5 -18.5	0.03 (4)	10.00			
F-G	0 17	0.0 0.0	0.01 (1)	10.00			
G-C	-119 0	0.0 0.0	0.01 (1)	7.81			
F-E	0 2	-18.5 -18.5	0.01 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPC 2011, TPC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CS1: TC=0.08:1.00 (D-E:1), 8C=0.03:1.00 (G-H:1).
WB=0.03:1.00 (D-G:1), SS=0.07:1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.19 (B) INPUT = 0.90
JSI METAL = 0.11 (B) INPUT = 1.00



Structural component only
DWG# T-2007615


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T20	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 3.10 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:04:02 2020 Page 1

ID:DMCubINVR6TstF0e31v6l zns1l-x73EgNd7XbU6sascoDbPaw0PaBNFZ7YIIB c8zMEMh

1-3-8 0-0 1-10-0 5-2-12 1-12 8-2-8 11-3-2 6-3-14 17-7-0 6-3-14 23-10-14 6-5-2 30-4-0 4-10-0 35-2-0 1-3-8
Scale = 1:57.6

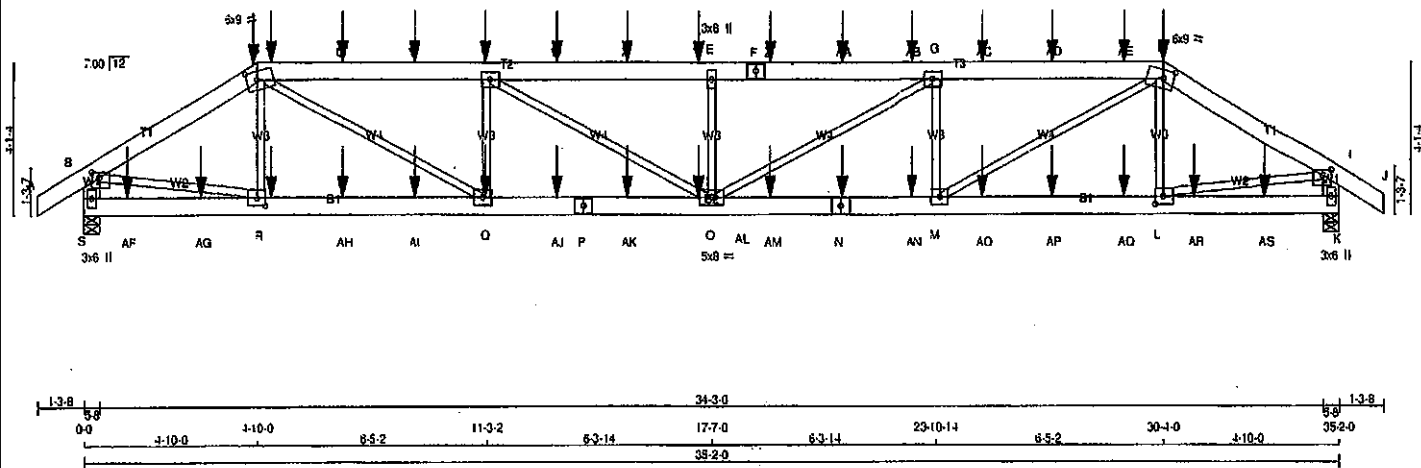

TOTAL WEIGHT = 2 X 180 = 359 lb (M)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x8 DRY No.2	SPF			
C - F	2x6 DRY No.2	SPF			
F - H	2x6 DRY No.2	SPF			
H - J	2x6 DRY No.2	SPF			
S - B	2x6 DRY No.2	SPF			
K - I	2x6 DRY No.2	SPF			
S - P	2x6 DRY No.2	SPF			
P - N	2x6 DRY No.2	SPF			
N - K	2x6 DRY No.2	SPF			

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 2 12	SIDE(122.0)	
C - F 2 12	SIDE(183.1)	
F - H 2 12	SIDE(61.0)	
H - J 2 12	SIDE(122.0)	
S - B 2 12	TOP	
K - I 2 12	TOP	
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S - P 2 12	SIDE(183.1)	
P - N 2 12	SIDE(0.0)	
N - K 2 12	SIDE(0.0)	
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1 8		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
S	3423	0	3423	0	5-8
K	3385	0	3385	0	5-8

UNFACTORED REACTIONS					
	1ST LCASE	MAX/MIN COMPONENT REACTIONS			
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
S	2418	1600	0	0	0
K	2378	1573	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.03 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LBS)	MEMB.	MAX. FORCE (LBS)	FACTORED MAX. CS (LBS)	
FR-TO		FROM TO		FR-TO			
A-B	0 33	-91.8 -91.8 0.04 (1)	10.00	R-C	-431 9	0.06 (1)	
B-C	-4881 0	-91.8 -91.8 0.13 (1)	5.23	C-Q	0 3534	0.44 (1)	
C-T	-7102 0	-91.8 -91.8 0.31 (1)	4.28	Q-D	-1555 0	0.19 (1)	
T-U	-7102 0	-91.8 -91.8 0.31 (1)	4.28	D-O	0 1048	0.13 (1)	
U-V	-7102 0	-91.8 -91.8 0.31 (1)	4.28	O-E	-884 0	0.10 (1)	
V-D	-7102 0	-91.8 -91.8 0.31 (1)	4.28	O-G	0 1085	0.13 (1)	
D-W	-8010 0	-91.8 -91.8 0.32 (1)	4.05	M-H	-1573 0	0.19 (1)	
W-X	-8010 0	-91.8 -91.8 0.32 (1)	4.05	M-H	0 3572	0.44 (1)	
X-Y	-8010 0	-91.8 -91.8 0.32 (1)	4.05	L-H	-421 10	0.05 (1)	
Y-E	-8010 0	-91.8 -91.8 0.32 (1)	4.05	B-R	0 4088	0.51 (1)	
E-F	-8010 0	-91.8 -91.8 0.33 (1)	4.03	L-I	0 -4022	0.50 (1)	
F-Z	-8010 0	-91.8 -91.8 0.33 (1)	4.03				
Z-AA	-8010 0	-91.8 -91.8 0.33 (1)	4.03				
AA-AB	-8010 0	-91.8 -91.8 0.33 (1)	4.03				
AB-G	-8010 0	-91.8 -91.8 0.33 (1)	4.03				
G-AC	-7070 0	-91.8 -91.8 0.30 (1)	4.27				
AC-AD	-7070 0	-91.8 -91.8 0.30 (1)	4.27				
AD-AE	-7070 0	-91.8 -91.8 0.30 (1)	4.27				
AE-H	-7070 0	-91.8 -91.8 0.30 (1)	4.27				
H-I	-4806 0	-91.8 -91.8 0.13 (1)	5.28				
I-J	0 33	-91.8 -91.8 0.04 (1)	10.00				
S-B	-3367 0	0.0 0.0 0.12 (1)	7.58				
K-I	-3318 0	0.0 0.0 0.12 (1)	7.83				

S-AF	0 0	-18.5 -18.5 0.08 (4)	10.00
AF-AG	0 0	-18.5 -18.5 0.08 (4)	10.00
AG-R	0 0	-18.5 -18.5 0.08 (4)	10.00
R-AH	0 4024	-18.5 -18.5 0.31 (1)	10.00
AH-AI	0 4024	-18.5 -18.5 0.31 (1)	10.00
AI-Q	0 4024	-18.5 -18.5 0.31 (1)	10.00
Q-AJ	0 7102	-18.5 -18.5 0.52 (1)	10.00
AJ-P	0 7102	-18.5 -18.5 0.52 (1)	10.00
P-AK	0 7102	-18.5 -18.5 0.52 (1)	10.00
AK-AL	0 7102	-18.5 -18.5 0.52 (1)	10.00
AL-O	0 7102	-18.5 -18.5 0.52 (1)	10.00
O-AM	0 7070	-18.5 -18.5 0.52 (1)	10.00
AM-N	0 7070	-18.5 -18.5 0.52 (1)	10.00
N-AN	0 7070	-18.5 -18.5 0.52 (1)	10.00
AN-M	0 7070	-18.5 -18.5 0.52 (1)	10.00
MAO	0 3960	-18.5 -18.5 0.30 (1)	10.00
AO-AP	0 3960	-18.5 -18.5 0.30 (1)	10.00
AP-AO	0 3960	-18.5 -18.5 0.30 (1)	10.00
AO-L	0 3960	-18.5 -18.5 0.30 (1)	10.00

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN.C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLES WITH:
- PART 9 OF NBCC 2010, NBCC 2012, ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.20")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.37")

CSI: TC=0.33/1.00 (E-G:1), GC=0.52/1.00 (O-Q:1),
WB=0.51/1.00 (B-R:1), SSI=0.18/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (Q1) INPUT = 0.90)
JSI METAL = 0.89 (P1) INPUT = 1.00)

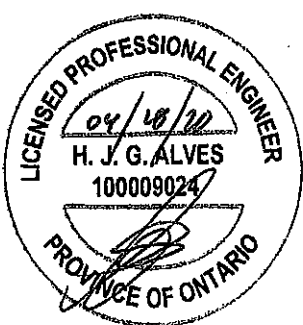

Structural component only
DWG# T-2007632 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T20	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 M/Tek Industries, Inc. Tue Apr 26 10:04:02 2020 Page 2

ID:DMCubINVR6TslF0g31v6l zns1l-x73EqNd7IXbU6sescDpPaw0PaBNFZ7YIB c8zMEMh

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	2.75
C	TTWW-m	MT20	6.0	9.0	2.75	3.50
D	TMVW-l	MT20	5.0	6.0		
E	TMVW-w	MT20	3.0	6.0		
F	TS-l	MT20	5.0	6.0		
G	TMVW-l	MT20	5.0	6.0		
H	TTWW-m	MT20	6.0	9.0	2.75	3.50
I	TMVW-p	MT20	5.0	6.0	1.75	2.75
K	BMV1-p	MT20	3.0	6.0		
L	BMVW-l	MT20	5.0	6.0	2.50	2.75
M	BMVW-l	MT20	5.0	6.0		
N	BS-l	MT20	5.0	6.0		
O	BMVW-l	MT20	5.0	6.0		
P	BS-l	MT20	5.0	6.0		
Q	BMVW-l	MT20	5.0	6.0		
R	BMVW-l	MT20	5.0	6.0	2.50	2.75
S	BMV1-p	MT20	3.0	6.0		

LOADING

TOTAL LOAD CASES: (4)


CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO		LENGTH FR-TO			
L-AR	0 0	-18.5 -18.5	0.08 (4)	10.00			
AR-AS	0 0	-18.5 -18.5	0.08 (4)	10.00			
AS-K	0 0	-18.5 -18.5	0.08 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-10-0	-60	-67	---	FRONT	VERT	DEAD	---	C1
C	4-10-0	-311	-311	---	FRONT	VERT	SNOW	---	C1
D	11-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	30-4-0	-60	-67	---	FRONT	VERT	DEAD	---	C1
H	30-4-0	-311	-311	---	FRONT	VERT	SNOW	---	C1
N	21-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Q	11-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
R	5-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	5-2-12	-138	-138	---	FRONT	VERT	TOTAL	---	C1
U	7-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	9-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	13-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	15-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	17-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	19-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	21-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	29-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	1-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	3-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	7-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	9-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	13-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	15-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AL	17-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AM	19-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AN	23-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AO	25-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AP	27-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AQ	29-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AR	31-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AS	33-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

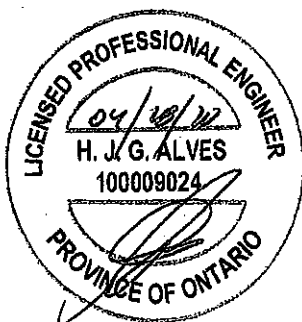

Structural component only
DWG# T-2007632


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T21	1	1	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Tue Apr 28 10:04:03 2020 Page 1

ID:DMCubINVR8TstFos31v8I zns11-PKdofelUqLk0D3AWqxoT6J Wk xSi yxX9bzMEMg

1-3.8 0-0 3-4.9 3-4.9 2-2.1 6-6.9 5-6.13 12-1.7 5-5.9 17-7.0 5-5.9 23-0.9 5-6.13 28-7.7 32-1 31-9.7 35-2.0 36-5.8 1-3.8
Scale = 1:57.6

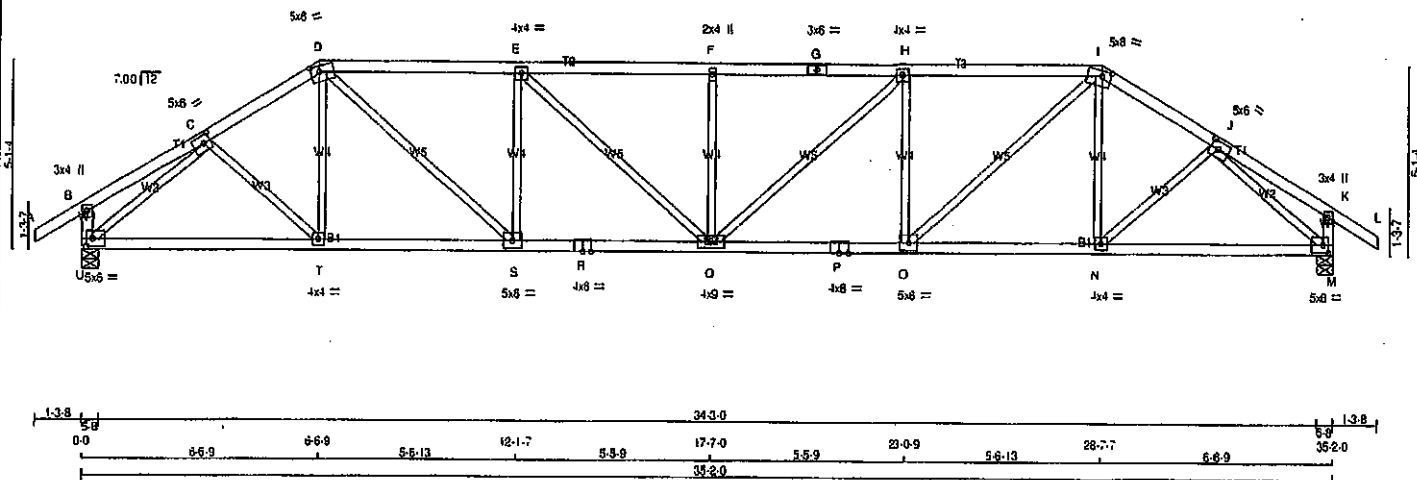


TOTAL WEIGHT = 142 LB

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
O - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
U - B	2x4	DRY	No.2
M - K	2x4	DRY	No.2
U - R	2x4	DRY	No.2
P - P	2x4	DRY	No.2
R - M	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			SPF

DRY: SEASONED LUMBER.

PLATES (tablets in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMV-p	MT20	3.0	4.0
C	TMWW-l	MT20	5.0	6.0 2.50 2.50
D	FTWW-m	MT20	5.0	6.0 1.75 3.00
E	TMWW-l	MT20	4.0	4.0
F	TMWW-v	MT20	2.0	4.0
G	TS-l	MT20	3.0	6.0
H	TMWW-l	MT20	4.0	4.0
I	FTWW-m	MT20	5.0	6.0 1.75 3.00
J	TMWW-l	MT20	5.0	6.0 2.50 2.50
K	TMV-p	MT20	3.0	4.0
M	BMVW-l	MT20	5.0	6.0 2.50 2.00
N	BMWW-l	MT20	4.0	4.0
O	BMWW-l	MT20	5.0	6.0
P	BS-l	MT20	4.0	6.0
Q	BMWW-l	MT20	4.0	6.0
R	BS-l	MT20	4.0	6.0
S	BMWW-l	MT20	5.0	6.0
T	BMWW-l	MT20	4.0	4.0
U	BMVW-l	MT20	5.0	6.0 2.50 2.00

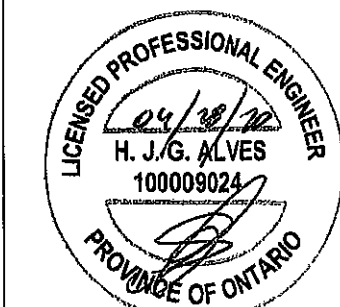

Structural component only
DWG# T-2007633

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED	MAXIMUM FACTORED	INPUT	REQD	
	GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
U	2084	0	2064	0	0
M	2064	0	2064	0	0

UNFACTORED REACTIONS

1ST CASE MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
U	1457	970	0	0	0
M	1457	970	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.12 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	MAX.	MEMB.	MAX. FACTORED	FACTORED	MAX.
	FORCE	VERT. LOAD	LOI		FORCE	MAX.	
	(LBS)	(PLF)	CSI (LC)		(LBS)	CSI (LC)	
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 32	-91.8	-91.8 0.12 (1)	10.00	C-T	0 213	0.05 (1)
B-C	0 13	-91.8	-91.8 0.12 (1)	10.00	T-D	-8 69	0.02 (1)
C-D	-2527 0	-91.8	-91.8 0.20 (1)	4.18	D-S	0 1447	0.33 (1)
D-E	-3264 0	-91.8	-91.8 0.66 (1)	3.30	S-E	-853 0	0.33 (1)
E-F	-3585 0	-91.8	-91.8 0.70 (1)	3.12	E-O	0 428	0.10 (1)
F-G	-3585 0	-91.8	-91.8 0.70 (1)	3.12	Q-F	-462 0	0.18 (1)
G-H	-3585 0	-91.8	-91.8 0.70 (1)	3.12	Q-H	0 428	0.10 (1)
H-I	-3264 0	-91.8	-91.8 0.66 (1)	3.30	O-H	-853 0	0.33 (1)
I-J	-2527 0	-91.8	-91.8 0.20 (1)	4.18	O-I	0 1447	0.33 (1)
J-K	0 13	-91.8	-91.8 0.12 (1)	10.00	N-I	-8 69	0.02 (1)
K-L	0 32	-91.8	-91.8 0.12 (1)	10.00	N-J	0 213	0.05 (1)
U-B	-249 0	0.0	0.0 0.03 (1)	7.81	U-C	-2671 0	0.82 (1)
M-K	-249 0	0.0	0.0 0.03 (1)	7.81	J-M	-2671 0	0.82 (1)
U-T	0 2005	-18.5	-18.5 0.42 (1)	10.00			
T-S	0 2167	-18.5	-18.5 0.44 (1)	10.00			
S-R	0 3264	-18.5	-18.5 0.58 (1)	10.00			
R-Q	0 3264	-18.5	-18.5 0.58 (1)	10.00			
Q-P	0 3264	-18.5	-18.5 0.58 (1)	10.00			
P-O	0 3264	-18.5	-18.5 0.58 (1)	10.00			
O-N	0 2167	-18.5	-18.5 0.44 (1)	10.00			
N-M	0 2005	-18.5	-18.5 0.42 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CSI: TC=0.70/1.00 (E-F:1), BC=0.58/1.00 (G-S:1), WB=0.82/1.00 (J-M:1), SS=0.24/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1587 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (M) (INPUT = 0.90)
JSI METAL = 0.74 (R) (INPUT = 1.00)


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T22	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:04 2020 Page 1

ID:DMCubINVR6TstFos31v6I zns11-1WB743eNF8CMAoFJDG3U70GFOtTTrCcg4h1zMEMM

1-3.8 0.0 4-2.13 4-2.13 4-0.5 3-3.2 5-3.0 14-6.2 8-1.12 20-7.14 6-3.0 26-10.14 4-0.5 30-11.3 4-2.13 1-3.8
Scale = 1:57.6

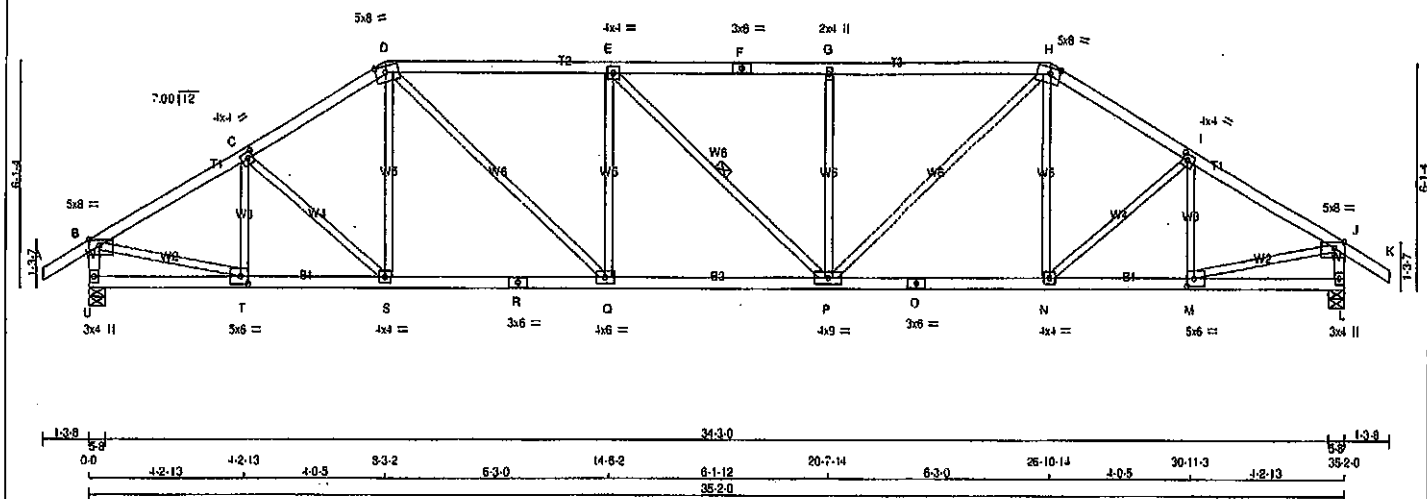

TOTAL WEIGHT = 148 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
U - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	8.0	Edge 3.50
C	TMWW-I	MT20	4.0	4.0	2.00 1.75
D	TTWW-m	MT20	5.0	8.0	2.00 3.50
E	TMWW-I	MT20	4.0	4.0	
F	TS-I	MT20	3.0	6.0	
G	TMVW-w	MT20	2.0	4.0	
H	TTWW-m	MT20	5.0	8.0	2.00 3.50
I	TMWW-I	MT20	4.0	4.0	2.00 1.75
J	TMVW-p	MT20	5.0	8.0	Edge 3.50
L	BMV-I-p	MT20	3.0	4.0	
M	BMWW-I	MT20	5.0	8.0	2.50 2.50
N	BMWW-I	MT20	4.0	4.0	
O	BS-I	MT20	3.0	6.0	
P	BMWW-I	MT20	4.0	9.0	
Q	BMWW-I	MT20	4.0	6.0	
R	BS-I	MT20	3.0	6.0	
S	BMWW-I	MT20	4.0	4.0	
T	BMWW-I	MT20	5.0	8.0	2.50 2.50
U	BMV-I-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED	GROSS REACTION		MAXIMUM FACTORED		INPUT	REQD
		DOWN	HORIZ	DOWN	HORIZ	BRG	BRG
JT	VERT						
U	2064	0	2064	0	0	5-8	5-8
L	2064	0	2064	0	0	5-8	5-8

UNFACTORED REACTIONS							
1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
JT	COMBINED						
U	1457	970	0	0	0	0	488 0
L	1457	970	0	0	0	0	488 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.37 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. UNBRACED LENGTH (FT)
FR-TO				FR-TO			
A-B	0 32	-91.8	-91.8 0.12 (1)	10.00	T-C	-428 0	0.10 (1)
B-C	-2468 0	-91.8	-91.8 0.35 (1)	4.07	C-S	-39 0	0.02 (1)
C-D	-2478 0	-91.8	-91.8 0.34 (1)	4.05	S-D	0 131	0.04 (4)
D-E	-2910 0	-91.8	-91.8 0.75 (1)	3.37	D-Q	0 1076	0.24 (1)
E-F	-2909 0	-91.8	-91.8 0.74 (1)	3.38	Q-E	-617 0	0.38 (1)
F-G	-2909 0	-91.8	-91.8 0.74 (1)	3.38	E-P	-2 0	0.00 (1)
G-H	-2909 0	-91.8	-91.8 0.75 (1)	3.38	P-G	-617 0	0.38 (1)
H-I	-2478 0	-91.8	-91.8 0.34 (1)	4.05	P-H	0 1073	0.24 (1)
I-J	-2468 0	-91.8	-91.8 0.35 (1)	4.07	N-H	0 132	0.04 (4)
J-K	0 32	-91.8	-91.8 0.12 (1)	10.00	N-I	-39 0	0.02 (1)
U-B	-2025 0	0.0	0.0 0.21 (1)	5.94	M-I	-426 0	0.10 (1)
L-J	-2025 0	0.0	0.0 0.21 (1)	5.94	B-T	0 2205	0.50 (1)
U-T	0 0	-18.5	-18.5 0.07 (4)	10.00	M-J	0 2205	0.50 (1)
T-S	0 2149	-18.5	-18.5 0.41 (1)	10.00			
S-R	0 2122	-18.5	-18.5 0.41 (1)	10.00			
R-Q	0 2122	-18.5	-18.5 0.41 (1)	10.00			
Q-P	0 2910	-18.5	-18.5 0.54 (1)	10.00			
P-O	0 2122	-18.5	-18.5 0.41 (1)	10.00			
O-N	0 2122	-18.5	-18.5 0.41 (1)	10.00			
N-M	0 2149	-18.5	-18.5 0.41 (1)	10.00			
M-L	0 0	-18.5	-18.5 0.07 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.16')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.30')

CSI: TC=0.75:1.00 (D-E:1), BC=0.54:1.00 (P-Q:1), WB=0.50:1.00 (B-T:1), SI=0.27:1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.69 (T) (INPUT = 0.90)
JSI METAL= 0.70 (D) (INPUT = 1.00)




Structural component only
DWG# T-2007634

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T23	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington


Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 26 16:04:06 2020 Page 1
ID:DMCubINVR6TsiFoe31v6l zns11-pvjIVkgeml5w0UyereIXZQ5aqCaVBjG8gw9BvzMEMd

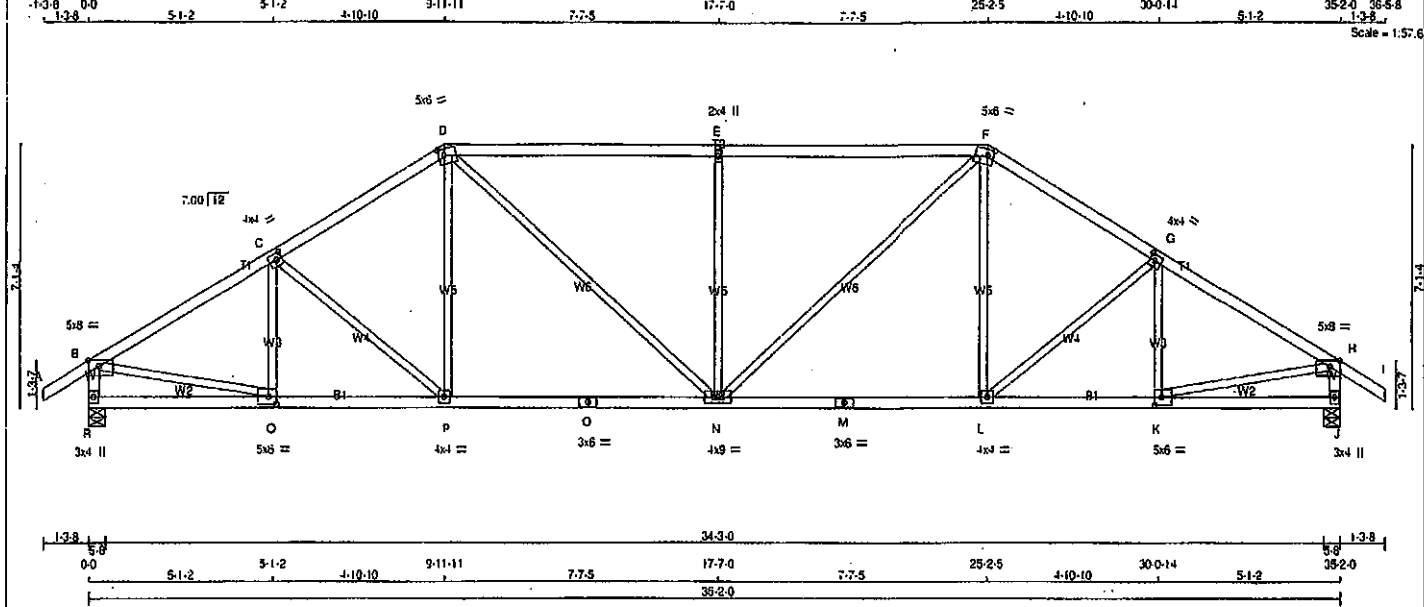

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2
H - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMWW-p	MT20	5.0	8.0 Edge 3.50
C	TMWW-t	MT20	4.0	4.0 2.00 1.75
D	ITWW-m	MT20	5.0	8.0 2.00 2.00
E	TMWW-w	MT20	2.0	4.0
F	ITWW-m	MT20	5.0	8.0 2.00 2.00
G	TMWW-t	MT20	4.0	4.0 2.00 1.75
H	TMWW-p	MT20	5.0	8.0 Edge 3.50
J	BMVt-p	MT20	3.0	4.0
K	BMWW-t	MT20	5.0	6.0 2.50 2.50
L	BMWW-t	MT20	4.0	4.0
M	BS-t	MT20	3.0	6.0
N	BMWW-w	MT20	4.0	9.0
O	BS-t	MT20	3.0	6.0
P	BMWW-t	MT20	4.0	4.0
Q	BMWW-t	MT20	5.0	6.0 2.50 2.50
R	BMVt-p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

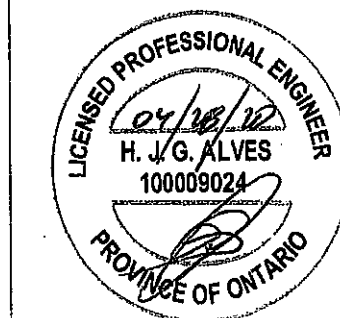

Structural component only
DWG# T-2007635

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BRG	BRG
R	2084	0	2084	0	0	5-8	5-8		
J	2084	0	2084	0	0	5-8	5-8		

UNFACTORED REACTIONS		1ST LOOSE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERMANENT	WIND
R	1457	970	0	0	0
J	1457	970	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.16 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	FORCE (LBS)	MEMB.	FORCE (LBS)
FR-TO	FROM TO	FR-TO	FROM TO
A-B	0 32	C-C	-335 0
B-C	-2537 0	D-D	-216 0
C-D	-2396 0	E-E	0 258
D-E	-2809 0	F-F	0 752
E-F	-2609 0	G-G	-880 0
F-G	-2396 0	H-H	0 752
G-H	-2537 0	I-I	0 258
H-I	0 32	J-J	-216 0
I-J	-2020 0	K-K	-335 0
J-K	-2020 0	L-L	0 2253
K-L	0 0	M-M	0 2253
L-M	0 0	N-N	0 0
M-N	0 0	O-O	0 0
N-O	0 0	P-P	0 0
O-P	0 0	Q-Q	0 0
P-Q	0 0	R-R	0 0
Q-R	0 0	S-S	0 0
R-S	0 0	T-T	0 0
S-T	0 0	U-U	0 0
T-U	0 0	V-V	0 0
U-V	0 0	W-W	0 0
V-W	0 0	X-X	0 0
W-X	0 0	Y-Y	0 0
X-Y	0 0	Z-Z	0 0
Y-Z	0 0		
Z	0 0		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 5.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2013 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.13")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.27")

CSI: TC=0.88(1.00(E-F:1)), BC=0.45(1.00(K-L:1)), WB=0.75(1.00(E-N:1)), SS=0.34(1.00(E-F:1))

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.88 (K) (INPUT = 0.90)
JSI METAL=0.72 (M) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T24	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 M/Tek Industries, Inc. Tue Apr 28 10:04:07 2020 Page 1
 ID:DMCubINVR6TslFoe31v6L_zns1l-H5s7i4hGX3DnDeWqPLpm6eepobw_wk9HuavkiMzMEMc
 35-2-0 36-5-8 1-3-8
 Scale = 1:57.6

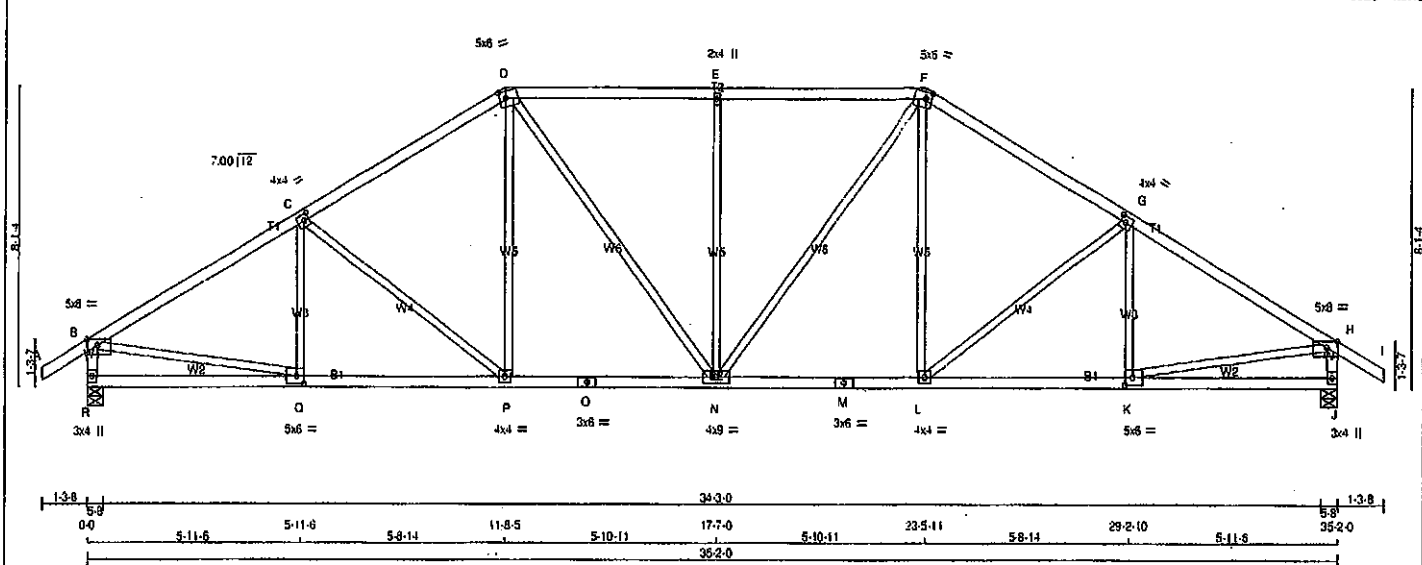

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2
H - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (Table is in inches)			
JT TYPE	PLATES	W	LEN Y X
B TMVW-p	MT20	5.0	8.0 Edge 3.50
C TMVW-l	MT20	4.0	4.0 2.00 1.75
D ITWW-m	MT20	5.0	6.0 2.25 2.00
E TMVW-w	MT20	2.0	4.0
F ITWW-m	MT20	5.0	6.0 2.25 2.00
G TMVW-l	MT20	4.0	4.0 2.00 1.75
H TMVW-p	MT20	5.0	8.0 Edge 3.50
J BMVW-l-p	MT20	3.0	4.0
K BMVW-l	MT20	5.0	6.0 2.50 2.50
L BMVW-l	MT20	4.0	4.0
M BS-l	MT20	3.0	6.0
N BMVW-w-l	MT20	4.0	9.0
O BS-l	MT20	3.0	8.0
P BMVW-l	MT20	4.0	4.0
Q BMVW-l	MT20	5.0	6.0 2.50 2.50
R BMVW-l-p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
R	2084	0	2084	0	5-8
J	2084	0	2084	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
R	1457	970 0	0 0	488 0	0 0
J	1457	970 0	0 0	488 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.81 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO	FROM TO	FR-TO	FROM TO
A-B	0 32	Q-C	-252 12
B-C	-2575 0	C-P	-388 0
C-D	-2283 0	P-D	0 345
D-E	-2238 0	D-N	0 480
E-F	-2236 0	N-E	-682 0
F-G	-2283 0	E-N	0 480
G-H	-2575 0	L-F	0 345
H-I	0 32	L-G	-388 0
R-B	-2016 0	B-Q	-252 12
J-H	-2016 0	K-Q	0 2281
R-Q	0 0	K-H	0 2281
Q-P	0 2251		
P-O	0 1947		
O-N	0 1947		
N-M	0 1947		
M-L	0 1947		
L-K	0 2251		
K-J	0 0		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NSCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CSI: TC=0.54/1.00 (B-C:1), BC=0.43/1.00 (P-Q:1), WB=0.84/1.00 (E-N:1), SS1=0.29/1.00 (O-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MT20	618	354	1887 788 1887 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.86 (Q) (INPUT = 0.90)
 JSI METAL= 0.61 (M) (INPUT = 1.00)



Structural component only
 DWG# T-2007636

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T25	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:08 2020 Page 1
 ID:DMCubINVR6TstFoe31v6l zns11-HQVwChuiNMdm50y3K?erAxP?FIGSR7DelqozMEMb
 35-20 36-58
 1-3.8 1-3.8 6-9-11 6-9-11 6-7-3 13-4-14 4-2-2 17-7-0 21-9-2 6-7-3 28-4-5 6-9-11 1-3.8
 Scale = 1:50.0

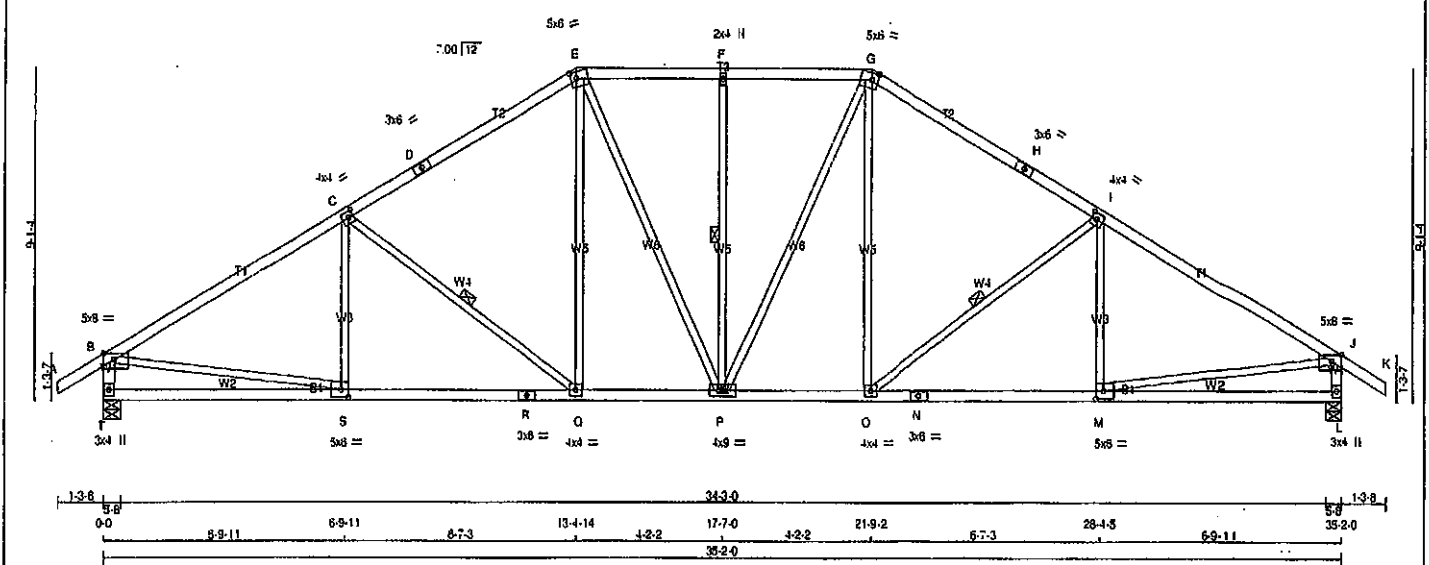

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
E	2x4	DRY	No.2
F - G	2x4	DRY	No.2
H - I	2x4	DRY	No.2
J - K	2x4	DRY	No.2
L - M	2x4	DRY	No.2
N - O	2x4	DRY	No.2
P - R	2x4	DRY	No.2
S - T	2x4	DRY	No.2
U - V	2x4	DRY	No.2
W - X	2x4	DRY	No.2
Y - Z	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY, SEASONED LUMBER.			

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMVW-p	MT20	5.0	8.0	Edge 3.50
C TMVW-l	MT20	4.0	4.0	2.00 1.75
D TS-l	MT20	3.0	6.0	
E TTWW-m	MT20	5.0	6.0	2.25 2.00
F TMVW-w	MT20	2.0	4.0	
G TTWW-m	MT20	5.0	6.0	2.25 2.00
H TS-l	MT20	3.0	6.0	
I TMVW-l	MT20	4.0	4.0	2.00 1.75
J TMVW-p	MT20	5.0	8.0	Edge 3.50
L BMV-l+p	MT20	3.0	4.0	
M BMVW-l	MT20	5.0	6.0	2.50 2.50
N BS-l	MT20	3.0	6.0	
O BMVW-l	MT20	4.0	4.0	
P BMVW-l	MT20	4.0	4.0	
Q BMVW-l	MT20	4.0	4.0	
R BS-l	MT20	3.0	6.0	
S BMVW-l	MT20	5.0	6.0	2.50 2.50
T BMV-l+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	HORZ	BRG	IN-SX	BRG	IN-SX
T	2064	0	0	2064	0	0	5-8	5-8	5-8
L	2064	0	0	2064	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST LOASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
T	1457	970	0	0	0	0	488	0	0
L	1457	970	0	0	0	0	488	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.54 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1:2 LENGTH OF C-Q, F-P, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING		TOTAL LOAD CASES: (4)							
CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX (PLF)	CS1 (LC)	MAX. UNBRAC	MEMB.	FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM	TO	LENGTH	FR-TO				
A-B	0 32	-91.8	-91.8 0.12 (1)	10.00	S-C	-165 51	0.08 (1)		
B-C	-2590 0	-91.8	-91.8 0.74 (1)	3.54	C-Q	-548 0	0.26 (1)		
C-D	-2156 0	-91.8	-91.8 0.68 (1)	3.91	Q-E	0 431	0.10 (1)		
D-E	-2156 0	-91.8	-91.8 0.86 (1)	3.91	E-P	0 286	0.08 (1)		
E-F	-1956 0	-91.8	-91.8 0.24 (1)	4.81	P-F	-460 0	0.25 (1)		
F-G	-1956 0	-91.8	-91.8 0.24 (1)	4.81	F-G	0 286	0.08 (1)		
G-H	-2156 0	-91.8	-91.8 0.68 (1)	3.91	O-G	0 431	0.10 (1)		
H-I	-2156 0	-91.8	-91.8 0.86 (1)	3.91	O-I	-548 0	0.26 (1)		
I-J	-2590 0	-91.8	-91.8 0.74 (1)	3.54	M-I	-165 51	0.08 (1)		
J-K	0 32	-91.8	-91.8 0.12 (1)	10.00	S-S	0 2292	0.52 (1)		
T-B	-2011 0	0.0	0.0 0.20 (1)	5.95	M-J	0 2292	0.52 (1)		
L-J	-2011 0	0.0	0.0 0.20 (1)	5.95					

T-S	0 0	-18.5	-18.5 0.20 (4)	10.00
S-R	0 2269	-18.5	-18.5 0.46 (1)	10.00
R-Q	0 2269	-18.5	-18.5 0.46 (1)	10.00
Q-P	0 1833	-18.5	-18.5 0.38 (1)	10.00
P-O	0 1833	-18.5	-18.5 0.38 (1)	10.00
O-N	0 2269	-18.5	-18.5 0.46 (1)	10.00
N-M	0 2269	-18.5	-18.5 0.46 (1)	10.00
M-L	0 0	-18.5	-18.5 0.20 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF NBCC 2018, NBC 2012, ABC 2019
 - PART 9 OF NBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFLL(LL) = L/360 (1.17")
 CALCULATED VERT. DEFLL(LL) = L/999 (0.11")
 ALLOWABLE DEFLL(TL) = L/360 (1.17")
 CALCULATED VERT. DEFLL(TL) = L/999 (0.22")

CS1: TC=0.74(1.00)(J-I); BC=0.48(1.00)(M-O);
 WB=0.52(1.00)(J-M); SS1=0.28(1.00)(J-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.85 (S) INPUT = 0.901
 JSI METAL= 0.69 (N) INPUT = 1.001



Structural component only
 DWG# T-2007637

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T25A	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 26 10:04:09 2020 Page 1
ID:DMCubINVR6TstFae31v6I zns11-DU u8miW3gUUSxgCWmsEB3j6lPbOjwaMlOrMEzMEMA
34-10-0
Scale = 1:55.1

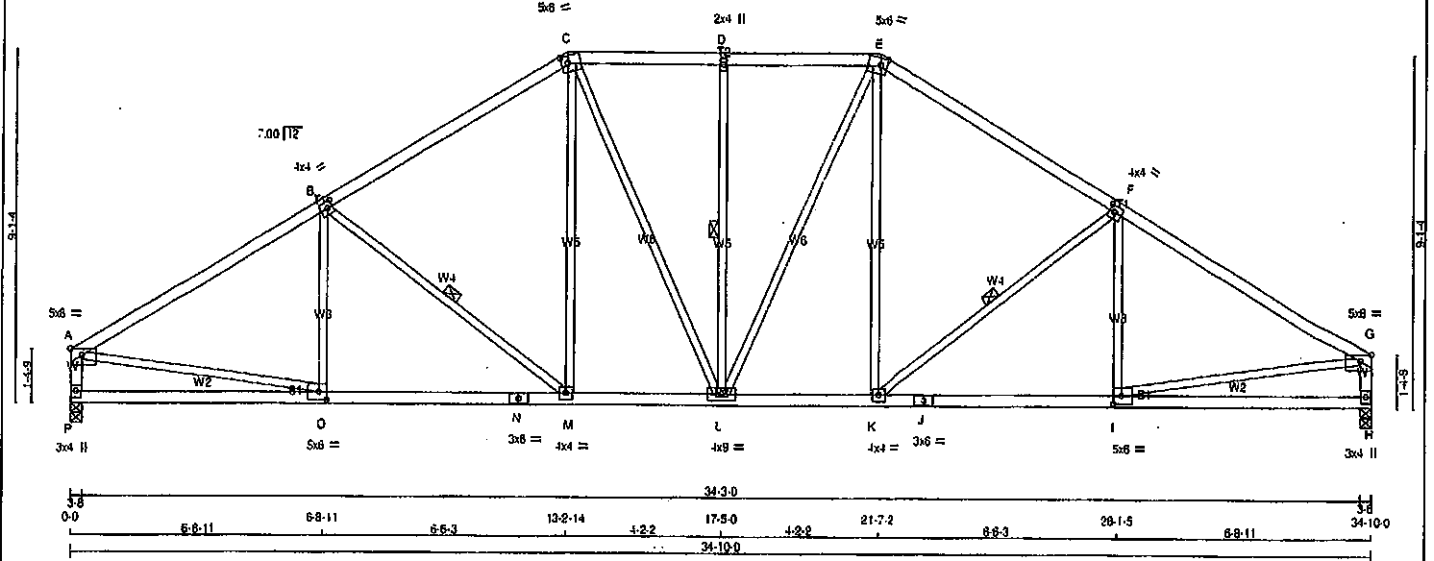

LUMBER	N. L. & A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
E - G	2x4	DRY	No.2	SPF	
P - A	2x4	DRY	No.2	SPF	
H - G	2x4	DRY	No.2	SPF	
P - N	2x4	DRY	No.2	SPF	
N - J	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-p	MT20	5.0	8.0	2.00	Edge
B	TMVW-t	MT20	4.0	4.0	2.00	1.75
C	TTWW-m	MT20	5.0	8.0	2.25	2.00
D	TMVW-w	MT20	2.0	4.0		
E	TTWW-m	MT20	5.0	8.0	2.25	2.00
F	TMVW-t	MT20	4.0	4.0	2.00	1.75
G	TMVW-p	MT20	5.0	8.0	Edge	3.50
H	BMVW-t	MT20	3.0	4.0		
I	BMVW-t	MT20	5.0	8.0	2.50	2.50
J	BS-t	MT20	3.0	6.0		
K	BMVW-t	MT20	4.0	4.0		
L	BMVW-w	MT20	4.0	9.0		
M	BMVW-t	MT20	4.0	4.0		
N	BS-t	MT20	3.0	6.0		
O	BMVW-t	MT20	5.0	8.0	2.50	2.50
P	BMVW-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG	BRG	BRG	BRG	BRG
P	1920	0	1920	0	0	3-8	3-8	3-8	3-8
H	1920	0	1920	0	0	3-8	3-8	3-8	3-8

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
P	1358	891 0	0 0	0 0	0 0	467 0	0 0	
H	1358	891 0	0 0	0 0	0 0	467 0	0 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.64 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF B-M, D-L, F-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		MAX.	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSF (LC)	MAX. UNBRAC	MEMB.	FORCE (LBS)	MAX. CSF (LC)
FR-TO		FROM	TO	LENGTH	FR-TO		
A-B	-2510 0	-91.8	-91.8 0.71 (1)	3.84	O-8	-212 40	0.09 (1)
B-C	-2113 0	-91.8	-91.8 0.83 (1)	3.99	B-M	-510 0	0.24 (1)
C-D	-1919 0	-91.8	-91.8 0.24 (1)	4.84	M-C	0 412	0.09 (1)
D-E	-1919 0	-91.8	-91.8 0.24 (1)	4.64	C-L	0 287	0.06 (1)
E-F	-2113 0	-91.8	-91.8 0.83 (1)	3.99	L-D	-461 0	0.25 (1)
F-G	-2510 0	-91.8	-91.8 0.71 (1)	3.84	L-E	0 287	0.06 (1)
P-A	-1868 0	0.0	0.0 0.19 (1)	6.13	K-E	0 412	0.09 (1)
H-G	-1868 0	0.0	0.0 0.19 (1)	6.13	K-F	-510 0	0.24 (1)
					I-F	-212 40	0.09 (1)
P-O	0 0	-18.5	-18.5 0.20 (4)	10.00	A-O	0 2227	0.50 (1)
O-N	0 2189	-18.5	-18.5 0.45 (1)	10.00	I-G	0 2227	0.50 (1)
N-M	0 2189	-18.5	-18.5 0.45 (1)	10.00			
M-L	0 1797	-18.5	-18.5 0.35 (1)	10.00			
L-K	0 1797	-18.5	-18.5 0.35 (1)	10.00			
K-J	0 2189	-18.5	-18.5 0.45 (1)	10.00			
J-I	0 2189	-18.5	-18.5 0.45 (1)	10.00			
I-H	0 0	-18.5	-18.5 0.20 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.16")
CALCULATED VERT. DEFL. (LL) = L/999 (0.11")
ALLOWABLE DEFL. (TL) = L/360 (1.16")
CALCULATED VERT. DEFL. (TL) = L/999 (0.21")

CSF: TC=0.71 (A-B:1), BC=0.45 (1.00 (M-O:1), WS=0.50 (1.00 (A-O:1), SS=0.28 (1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1887 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.84 (1) (INPUT = 0.90)
JSI METAL = 0.66 (1) (INPUT = 1.00)



Structural component only
DWG# T-2007638

JOB NAME 408223	TRUSS NAME T28	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 28 2019 MTak Industries, Inc. Tue Apr 28 10:04:10 2020 Page 1
ID:DMCubINVR6tstFoe31v8l zns1l-igYGL6j8q_cL45FP4UNTkGGKlpt777_kbX7PuhzMEM2
Scale = 1/4" = 1'-0"

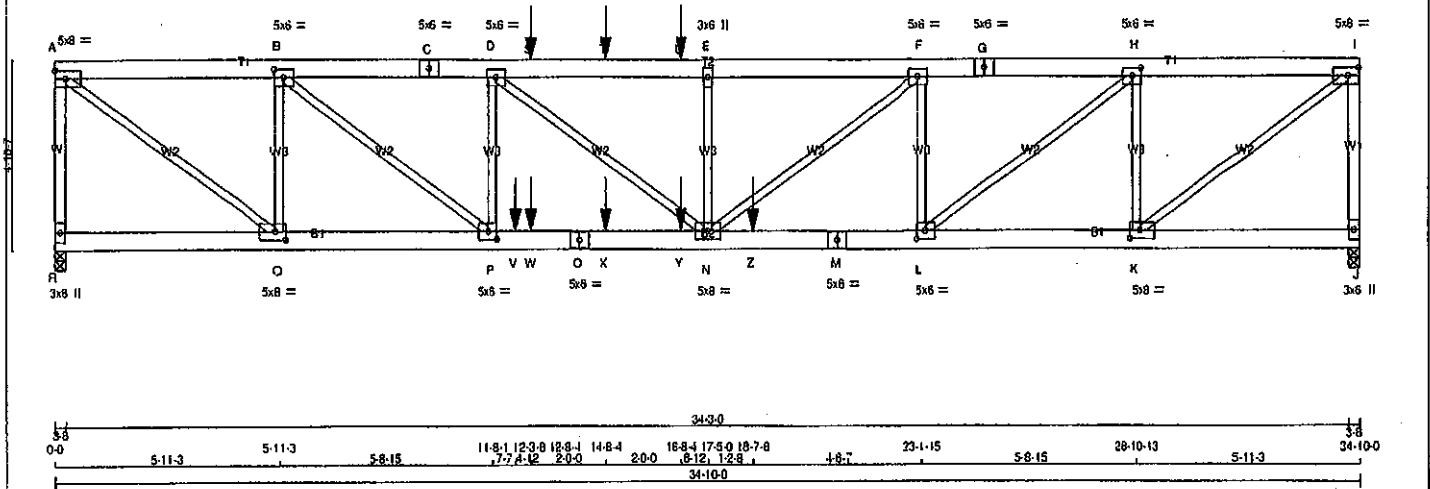

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
R - A	2x4	DRY	No.2
A - C	2x6	DRY	No.2
C - G	2x6	DRY	No.2
G - I	2x6	DRY	No.2
I - J	2x6	DRY	No.2
J - O	2x6	DRY	No.2
O - M	2x6	DRY	No.2
M - J	2x6	DRY	No.2

ALL WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
R - A 1 12	TOP	
I - J 1 12	TOP	
A - C 2 12	TOP	
C - G 2 12	TOP	
G - I 2 12	TOP	
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
R - O 2 12	SIDE(0.01)	
O - M 2 12	SIDE(0.01)	
M - J 2 12	TOP	
WEBS: (0.122"x3") SPIRAL NAILS		
2x3 1 6		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	DOWN	UPLIFT	IN-SX
R 3373 0	3373 0	0 3-8	3-8
J 3103 0	3103 0	0 3-8	3-8

UNFACTORED REACTIONS			
1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND
JT COMBINED	SNOW	LIVE	DEAD
R 2380 1591 0	0 0	0 0	789 0
J 2190 1459 0	0 0	0 0	731 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.03 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. MAX. CS1 (LC) UNBRAC
FR-TO			
R-A	-3316 0	0.0 0.0 0.58 (1)	8.39
A-B	-4149 0	-91.8 -91.8 0.14 (1)	5.47
B-C	-7288 0	-91.8 -91.8 0.20 (1)	4.33
C-D	-7288 0	-91.8 -91.8 0.20 (1)	4.33
D-E	-8278 0	-91.8 -91.8 0.28 (1)	4.03
E-F	-8278 0	-91.8 -91.8 0.28 (1)	4.03
F-G	-8278 0	-91.8 -91.8 0.28 (1)	4.03
G-H	-8278 0	-91.8 -91.8 0.28 (1)	4.03
H-I	-8278 0	-91.8 -91.8 0.28 (1)	4.03
I-J	-8278 0	-91.8 -91.8 0.28 (1)	4.03
J-O	-8278 0	-91.8 -91.8 0.28 (1)	4.03
O-M	-8278 0	-91.8 -91.8 0.28 (1)	4.03
M-J	-8278 0	-91.8 -91.8 0.28 (1)	4.03
JT			
R-O	0 0	-18.5 -18.5 0.04 (4)	10.00
O-P	0 -4149	-18.5 -18.5 0.30 (1)	10.00
P-V	0 7288	-18.5 -18.5 0.67 (1)	10.00
V-W	0 7288	-18.5 -18.5 0.67 (1)	10.00
W-O	0 7288	-18.5 -18.5 0.67 (1)	10.00
O-X	0 7288	-18.5 -18.5 0.67 (1)	10.00
X-Y	0 7288	-18.5 -18.5 0.67 (1)	10.00
Y-N	0 7288	-18.5 -18.5 0.67 (1)	10.00
N-Z	0 6588	-18.5 -18.5 0.72 (1)	10.00
Z-M	0 6588	-18.5 -18.5 0.72 (1)	10.00
M-L	0 6588	-18.5 -18.5 0.72 (1)	10.00
L-K	0 3787	-18.5 -18.5 0.32 (1)	10.00
K-J	0 0	-18.5 -18.5 0.04 (4)	10.00

WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. MAX. CS1 (LC)	
FR-TO			
K-I	0 4719	0.58 (1)	
A-Q	0 5171	0.84 (1)	
K-H	-2757 0	0.44 (1)	
Q-B	-2997 0	0.48 (1)	
L-H	0 3530	0.44 (1)	
B-P	0 3958	0.49 (1)	
L-F	-1791 0	0.28 (1)	
P-D	-1403 0	0.22 (1)	
N-F	0 2134	0.28 (1)	
D-N	0 1249	0.15 (1)	
N-E	-673 0	0.11 (1)	

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
S	12-8-4	-86	-86	---	BACK	VERT	TOTAL	---	C1
T	14-8-4	-86	-86	---	BACK	VERT	TOTAL	---	C1
U	16-8-4	-86	-86	---	BACK	VERT	TOTAL	---	C1
V	12-3-8	-1052	-1052	---	BACK	VERT	TOTAL	---	C1
W	12-8-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
X	14-8-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
Y	16-8-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
Z	18-7-8	-1273	-1273	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS
11 C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.38")

CSI: TG=0.58:1.00 (A-R:1), BC=0.72:1.00 (L-N:1), WB=0.64:1.00 (A-Q:1), SS=0.37:1.00 (L-N:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.89 (1) (INPUT = 0.90)
JSI METAL=0.73 (1) (INPUT = 1.00)



Structural component only
DWG# T-2007639 1/2

JOB NAME 408223	TRUSS NAME T28	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 M Tek Industries, Inc. Tue Apr 28 10:04:10 2020 Page 2 ID:DMCubINVR6TslF0e31v6l zns1l-igYGL68g cL45FP4UNtkGGKpl777 kbX7PuhzMEMZ	

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMWW-I	MT20	5.0	8.0	2.50 3.25
B	TMWW-I	MT20	5.0	6.0	2.50 2.75
C	TS-I	MT20	5.0	6.0	
D	TMWW-I	MT20	5.0	8.0	
E	TMWW-I	MT20	3.0	8.0	
F	TMWW-I	MT20	5.0	8.0	
G	TS-I	MT20	5.0	8.0	
H	TMWW-I	MT20	5.0	6.0	2.50 2.75
I	TMWW-I	MT20	5.0	8.0	2.50 3.25
J	BMV1-p	MT20	3.0	6.0	
K	BMWW-I	MT20	5.0	8.0	2.50 3.25
L	BMWW-I	MT20	5.0	6.0	2.50 2.75
M	BS-I	MT20	5.0	6.0	
N	BMWW-I	MT20	5.0	8.0	
O	BS-I	MT20	5.0	8.0	
P	BMWW-I	MT20	5.0	8.0	2.50 2.75
Q	BMWW-I	MT20	5.0	8.0	2.50 3.25
R	BMV1-p	MT20	3.0	6.0	

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

Structural component only
DWG# T-2007639 2/2


JOB NAME 408223	TRUSS NAME T29	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:11 2020 Page 1

ID:DMCubINVR6TslFoe31v6l zns1l-As6eYSkmbkCfQbeBuiGUoUPDljsbAtpBlyR7zMEMY
23-2-4 28-11-8 34-10-0

Scale = 1:54.8

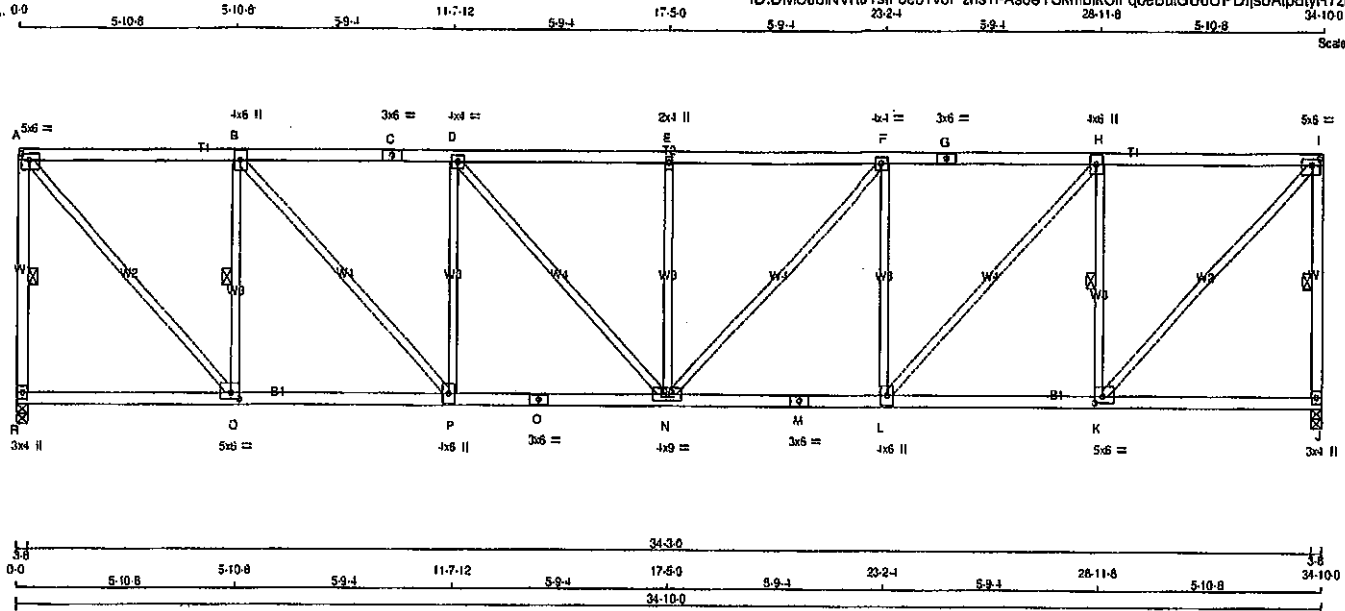

TOTAL WEIGHT = 2 X 157 = 314 lb

LUMBER			
N.L.G.A. RULES	SIZE	LUMBER	DESCR
CHORDS			
R - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
C - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
J - I	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS									
	FACTORED	MAXIMUM FACTORED	INPUT	RECORD					
	GROSS REACTION	GROSS REACTION	BRG	BRG					
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
R	1920	0	1920	0	0	3-8	3-8		
J	1920	0	1920	0	0	3-8	3-8		
UNFACTORED REACTIONS									
1ST LCASE	MAX.	MIN.	COMPONENT	REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
R	1358	891	0	0-0	0-0	0-0	467	0	0-0
J	1358	891	0	0-0	0-0	0-0	467	0	0-0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-R, I-J, B-Q, H-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
R-A	-1876	0	0.0 0.0 0.37 (1)	A-Q	0	2281	0.51 (1)
A-B	-1563	0	-91.8 -91.8 0.53 (1)	Q-B	-1540	0	0.43 (1)
B-C	-2428	0	-91.8 -91.8 0.63 (1)	B-P	0	1272	0.29 (1)
C-D	-2428	0	-91.8 -91.8 0.63 (1)	P-D	-831	0	0.58 (1)
D-E	-2725	0	-91.8 -91.8 0.58 (1)	D-N	0	440	0.10 (1)
E-F	-2725	0	-91.8 -91.8 0.58 (1)	N-E	-539	0	0.38 (1)
F-G	-2428	0	-91.8 -91.8 0.63 (1)	N-F	0	440	0.10 (1)
G-H	-2428	0	-91.8 -91.8 0.63 (1)	F-F	-831	0	0.58 (1)
H-I	-1563	0	-91.8 -91.8 0.53 (1)	L-H	0	1272	0.29 (1)
I-J	-1876	0	0.0 0.0 0.37 (1)	K-H	-1540	0	0.43 (1)
				K-I	0	2281	0.51 (1)
R-Q	0	0	-18.5 -18.5 0.15 (4)				
Q-P	0	1563	-18.5 -18.5 0.33 (1)				
P-O	0	2428	-18.5 -18.5 0.44 (1)				
O-N	0	2428	-18.5 -18.5 0.44 (1)				
N-M	0	2428	-18.5 -18.5 0.44 (1)				
M-L	0	2428	-18.5 -18.5 0.44 (1)				
L-K	0	1563	-18.5 -18.5 0.33 (1)				
K-J	0	0	-18.5 -18.5 0.15 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 240 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.16")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.31")

CS1: TC=0.63/1.00 (F-H:1), BC=0.44/1.00 (N-P:1), WB=0.58/1.00 (F-L:1), SSI=0.25/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656


PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.87 (A) (INPUT = 0.90)
JSI METAL= 0.78 (M) (INPUT = 1.00)



Structural component only
DWG# T-2007640

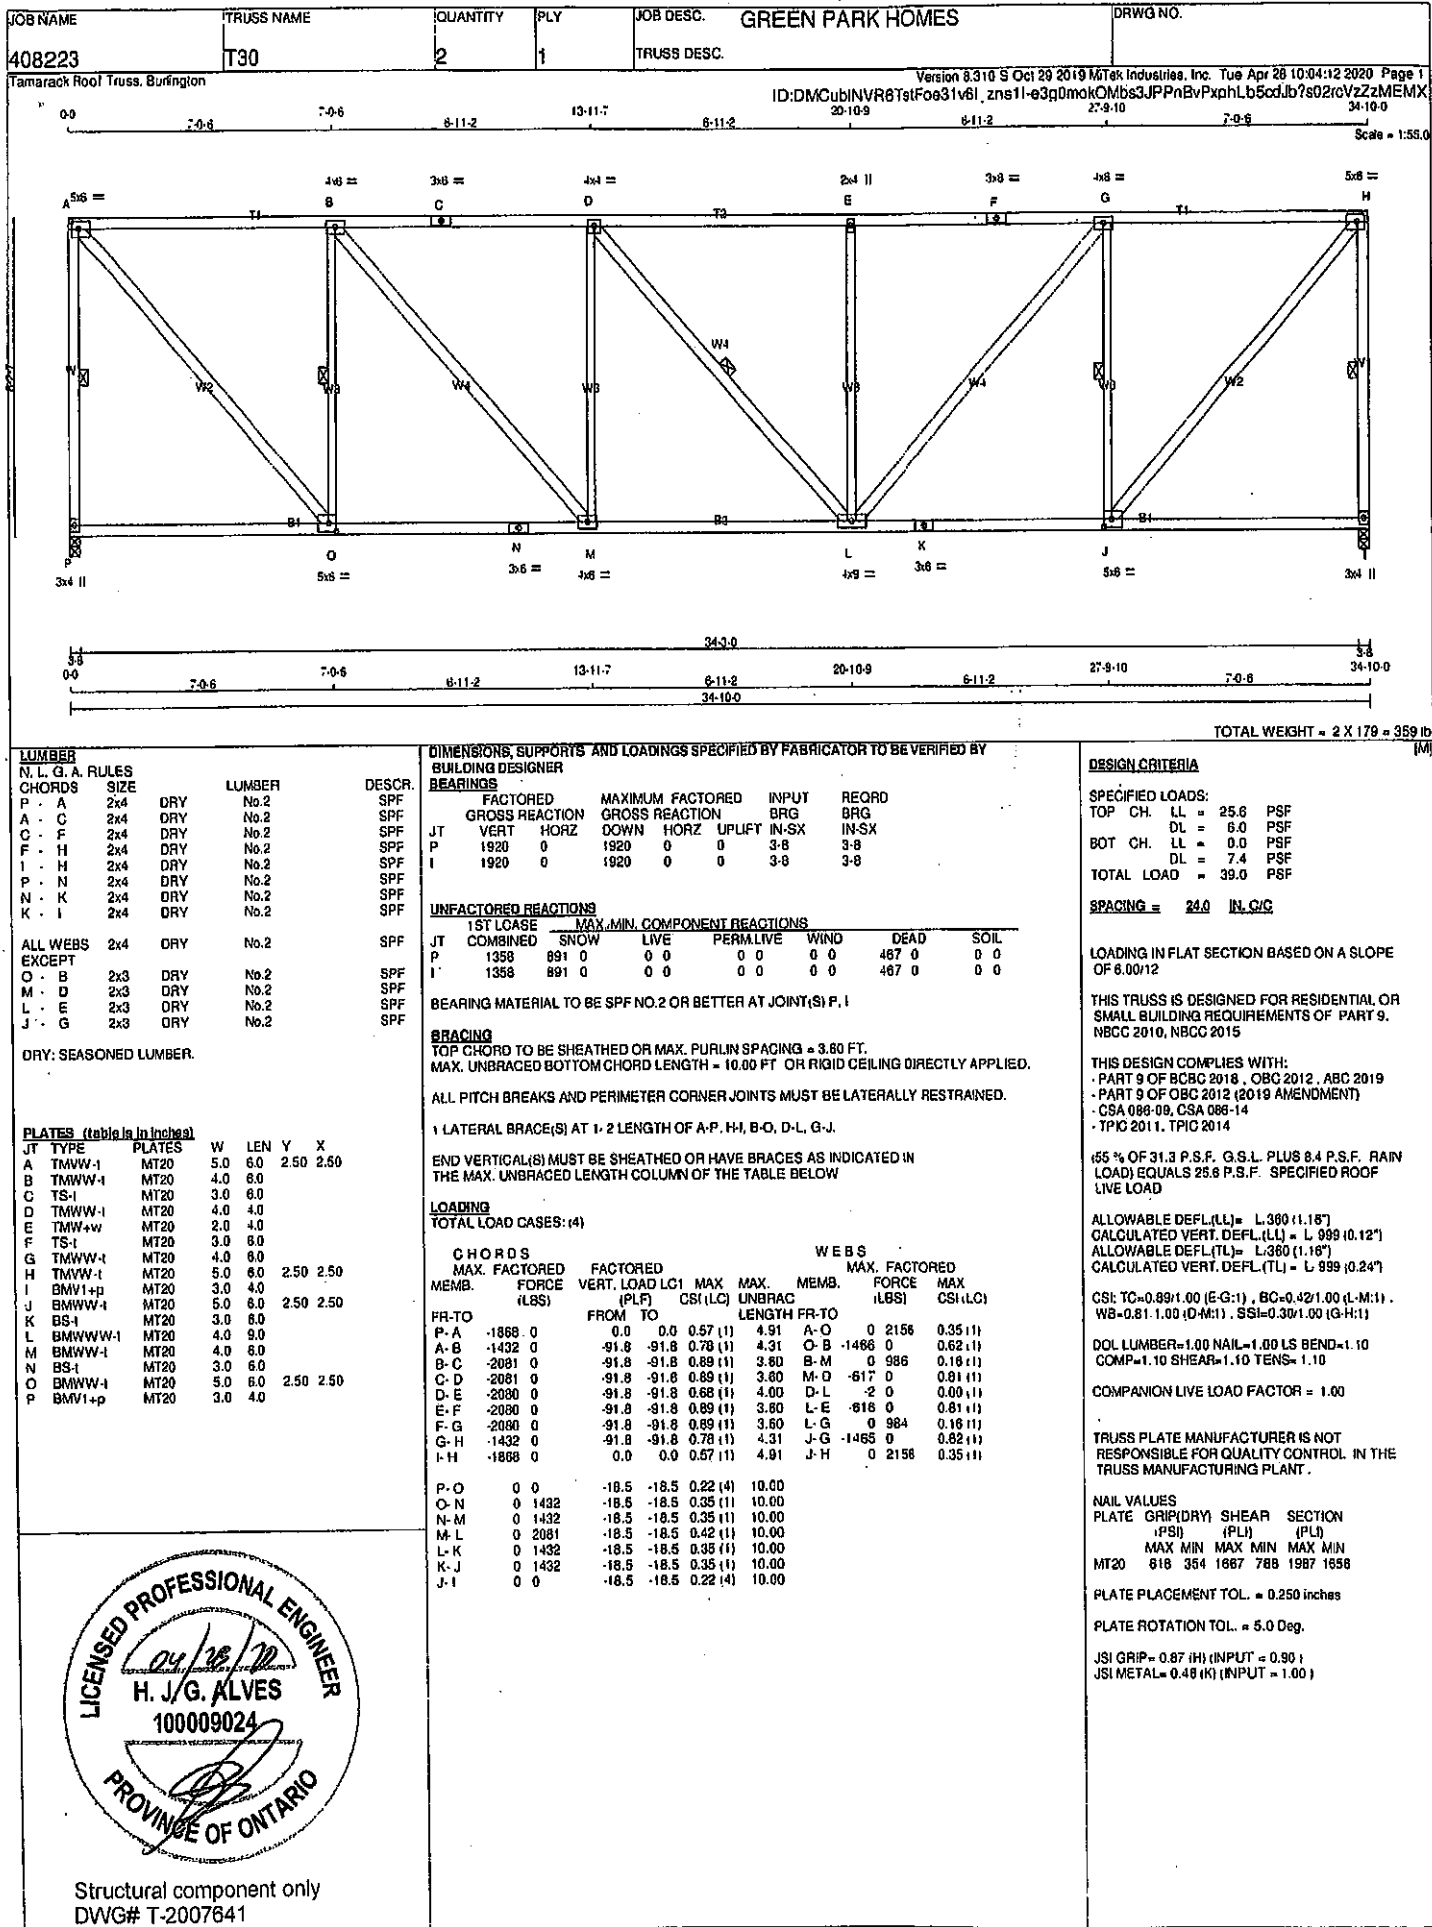

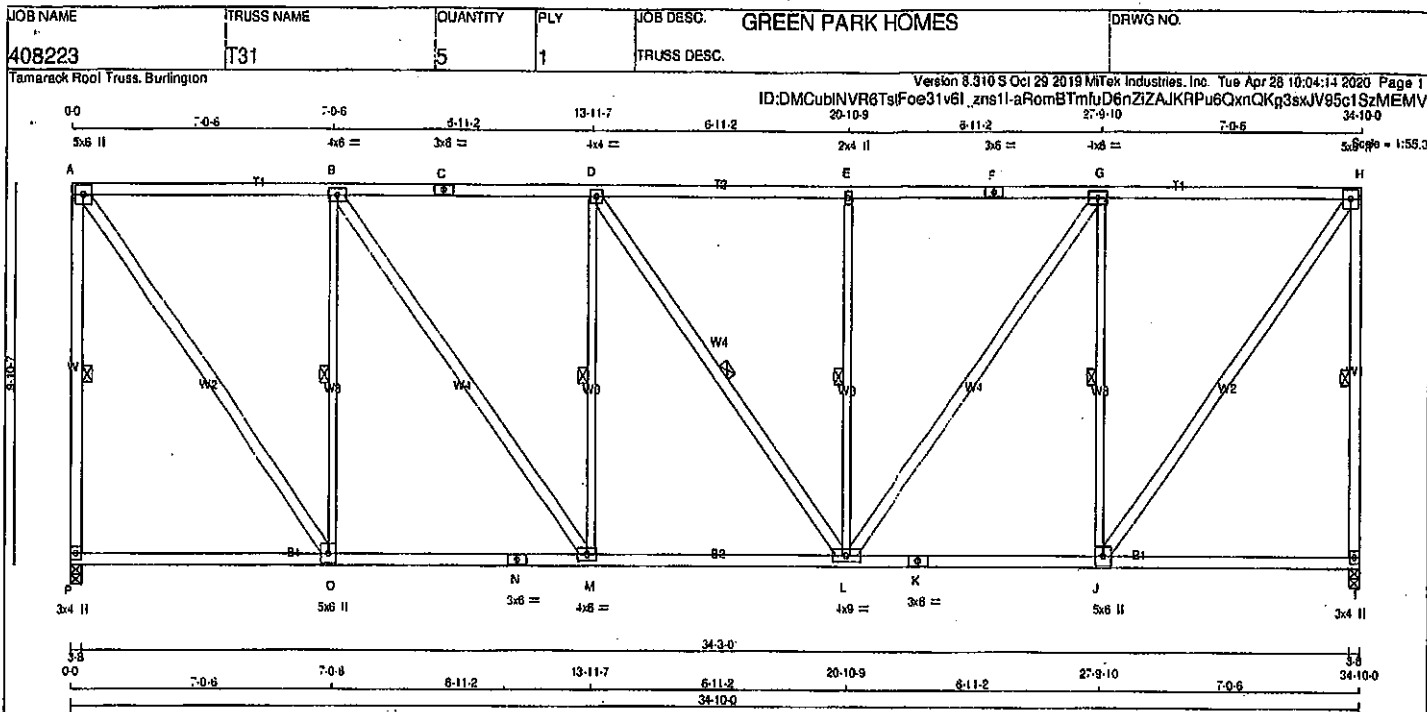

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
P - A	2x4	DRY No.2	SPF
A - C	2x4	DRY No.2	SPF
C - F	2x4	DRY No.2	SPF
F - H	2x4	DRY No.2	SPF
I - H	2x4	DRY No.2	SPF
P - N	2x4	DRY No.2	SPF
N - K	2x4	DRY No.2	SPF
K - I	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x4	DRY No.2	SPF
O - B	2x3	DRY No.2	SPF
M - D	2x3	DRY No.2	SPF
L - E	2x3	DRY No.2	SPF
J - G	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (tables in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	5.0	6.0		
B	TMVW-i	MT20	3.0	6.0		
C	TS-i	MT20	3.0	6.0		
D	TMVW-i	MT20	4.0	4.0		
E	TMVW-w	MT20	2.0	4.0		
F	TS-i	MT20	3.0	6.0		
G	TMVW-i	MT20	4.0	6.0		
H	TMVW+p	MT20	5.0	6.0		
I	BMV1+p	MT20	3.0	4.0		
J	BMVW-i	MT20	5.0	6.0		
K	BS-i	MT20	3.0	6.0		
L	BMVW-w	MT20	4.0	6.0		
M	BMVW-i	MT20	4.0	6.0		
N	BS-i	MT20	3.0	6.0		
O	BMVW-i	MT20	5.0	6.0		
P	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	RECORD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
P	1920	0	1920	0	3-8	3-8
I	1920	0	1920	0	3-8	3-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
P	1358	891 0	0 0	0 0	0 0	467 0	0 0
I	1358	891 0	0 0	0 0	0 0	467 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.98 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-P, H-I, B-O, D-M, D-L, E-L, G-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LG1 (PLF)	MAX. CS1(LC)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO		
P-A	-1888	0.0	0.0	0.88
A-B	-1183	-91.8	-91.8	0.75
B-C	-1719	-91.8	-91.8	0.82
C-D	-1719	-91.8	-91.8	0.82
D-E	-1718	-91.8	-91.8	0.83
E-F	-1718	-91.8	-91.8	0.83
F-G	-1718	-91.8	-91.8	0.83
G-H	-1183	-91.8	-91.8	0.75
H-I	-1888	0.0	0.0	0.88
P-O	0	0	-18.5	-18.5
O-N	0	1183	-18.5	-18.5
N-M	0	1183	-18.5	-18.5
M-L	0	1719	-18.5	-18.5
L-K	0	1183	-18.5	-18.5
K-J	0	1183	-18.5	-18.5
J-I	0	0	-18.5	-18.5

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012, ABC 2010
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CS1: TC=0.88/1.00 (H:1), BC=0.38/1.00 (L:M:1),
WB=0.88/1.00 (B:C:1), SS1=0.30/1.00 (G:H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (H) (INPUT = 0.90)
JSI METAL = 0.43 (H) (INPUT = 1.00)




Structural component only
DWG# T-2007642

JOB NAME 408223	TRUSS NAME T32	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:04:15 2020 Page 1
ID:DMCubINVR6TsF0a31v6L_zns1l-2dL9OpnHWEaAs8Mt1yeRKzCFqhAoVATkprAauzMEMU

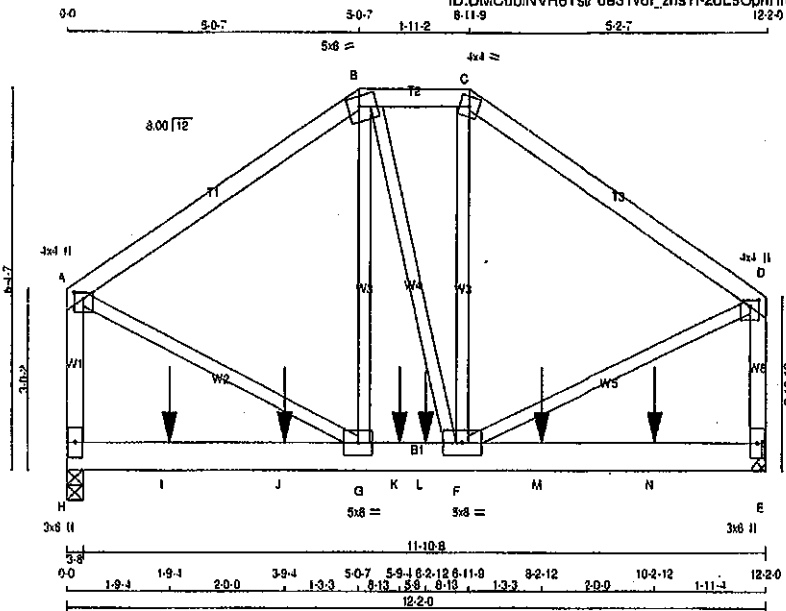

Scale = 1:35.6

TOTAL WEIGHT = 66 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
H - A	2x4	DRY	No.2
E - D	2x4	DRY	No.2
H - E	2x6	DRY	No.2

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TTWW-m	MT20	5.0	6.0	2.00	2.25
C	TTWW-m	MT20	4.0	4.0		
D	TMVW+p	MT20	4.0	4.0	1.25	2.00
E	BMV1+p	MT20	3.0	6.0		
F	BMVW-1	MT20	5.0	8.0		
G	BMVW-1	MT20	5.0	6.0		
H	BMV1+p	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
H	1233 0	1233 0	3-8	3-8
E	1218 0	1218 0	MECHANICAL	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 3-8.

UNFACTORED REACTIONS

JT	1ST LOUSE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
H	867	596 0	0 0	0 0	271 0	0 0
E	856	588 0	0 0	0 0	268 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	-353 0	-91.8 -91.8 0.48 (1)	5.88	G-B	0 122	0.03 (1)	
B-C	-721 0	-91.8 -91.8 0.07 (1)	6.25	B-F	0 34	0.01 (1)	
C-D	-864 0	-91.8 -91.8 0.51 (1)	5.77	F-C	0 154	0.04 (1)	
H-A	-1085 0	0.0 0.0 0.17 (1)	7.60	A-G	0 785	0.20 (1)	
E-D	-1057 0	0.0 0.0 0.18 (1)	7.63	F-D	0 794	0.20 (1)	
H-I	0 0	-18.5 -18.5 0.20 (1)	10.00				
I-J	0 0	-18.5 -18.5 0.20 (1)	10.00				
J-G	0 0	-18.5 -18.5 0.20 (1)	10.00				
G-K	0 711	-18.5 -18.5 0.28 (1)	10.00				
K-L	0 711	-18.5 -18.5 0.28 (1)	10.00				
L-F	0 711	-18.5 -18.5 0.28 (1)	10.00				
F-M	0 0	-18.5 -18.5 0.20 (1)	10.00				
M-N	0 0	-18.5 -18.5 0.20 (1)	10.00				
N-E	0 0	-18.5 -18.5 0.20 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
I	1-9-4	-172	-172	---	BACK	VERT	TOTAL	---	C1
J	3-9-4	-195	-195	---	BACK	VERT	TOTAL	---	C1
K	5-9-4	-187	-187	---	BACK	VERT	TOTAL	---	C1
L	8-2-12	-187	-187	---	BACK	VERT	TOTAL	---	C1
M	8-2-12	-195	-195	---	BACK	VERT	TOTAL	---	C1
N	10-2-12	-172	-172	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD = 39.0 PSF				

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPC 2011, TPC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.41")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.41")
CALCULATED VERT. DEFL. (TL) = L/999 (0.04")

CS1: TC=0.51 (C-D:1), BC=0.28 (1.00 (F-G:1), WB=0.20 (1.00 (A-G:1), SS=0.20 (1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	618	354	1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.78 (D) (INPUT = 0.90)
JSI METAL = 0.23 (D) (INPUT = 1.00)



Structural component only
DWG# T-2007643



JSMETAL= 0.0618 INPUT = 1.00




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T35S	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:04:17 2020 Page 1

ID:DMCubINVR6TstF0831v6l_zns1l-.0TvpVoXB8UMQAHl_S?8W2dvdRQGSEmC7KGanzMEMS

Scale = 1/23.4

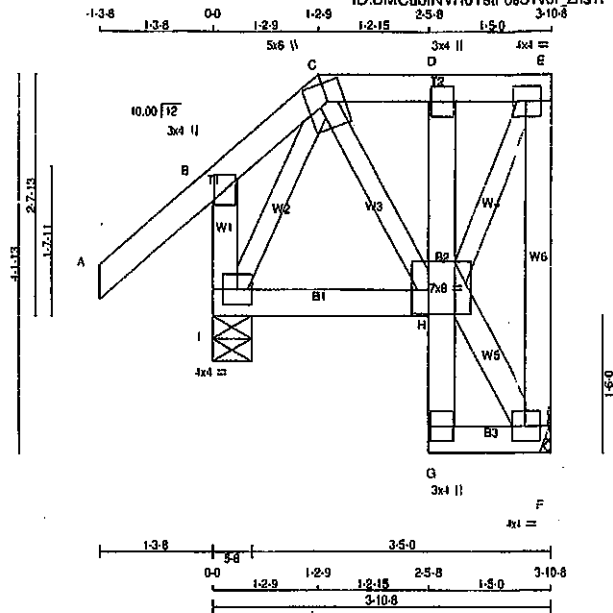

TOTAL WEIGHT = 2 X 29 = 57 lb

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER		
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
I - B	2x4	DRY	No.2	SPF	
I - H	2x4	DRY	No.2	SPF	
G - D	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
H - F	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
C	TTWW+m	MT20	5.0	6.0	2.50 2.25
D	TMV+p	MT20	3.0	4.0	
E	TMVW+1	MT20	4.0	4.0	
F	BMVW1-1	MT20	4.0	4.0	
G	BMV+p	MT20	3.0	4.0	
H	BMVWVW1-1	MT20	7.0	8.0	3.25 2.25
I	BMVW1-1	MT20	4.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REORD	
JT	VERT	HORZ	GROSS REACTION	DOWN	HORZ	BRG	BRG	IN-SX	IN-SX
F	191	0	191	0	0	5-8	5-8		
I	383	0	383	0	0	5-8	5-8		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS							
F	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
I	135	88 -13	0 0	0 0	0 0	49 0	0 0		
I	254	183 0	0 0	0 0	0 0	72 0	0 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 41	-91.8 -91.8 0.14 (5)	10.00	H-F	-6 0	0.00 (1)	
B-C	-35 0	-91.8 -91.8 0.14 (5)	8.25	H-E	0 141	0.03 (1)	
C-D	-69 0	-91.8 -91.8 0.02 (1)	8.25	C-H	0 38	0.01 (1)	
D-E	-67 0	-91.8 -91.8 0.02 (1)	8.25	I-C	-96 28	0.02 (1)	
F-E	-175 0	0 0 0.05 (1)	7.81				
I-B	-255 0	0 0 0.03 (1)	7.81				
I-H	-13 45	-18.5 -18.5 0.04 (4)	8.25				
G-H	0 13	0 0 0.01 (1)	10.00				
H-D	-135 0	0 0 0.01 (1)	7.81				
G-F	0 4	-18.5 -18.5 0.01 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPC 2011, TPC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.14/1.00 (A-B:5), BC=0.04/1.00 (H:4), WB=0.03/1.00 (E-H:1), SS=0.09/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	818	354	1887 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (E) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007645

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ORWG NO.
408223	T36	3	1	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:04:18 2020 Page 1

ID:DMCubINVR6TslFoe31v6l zns1l-TC1H0rp9yRcD1KsxY9WL2ybo51l27vNvQn3qBDzMEMR

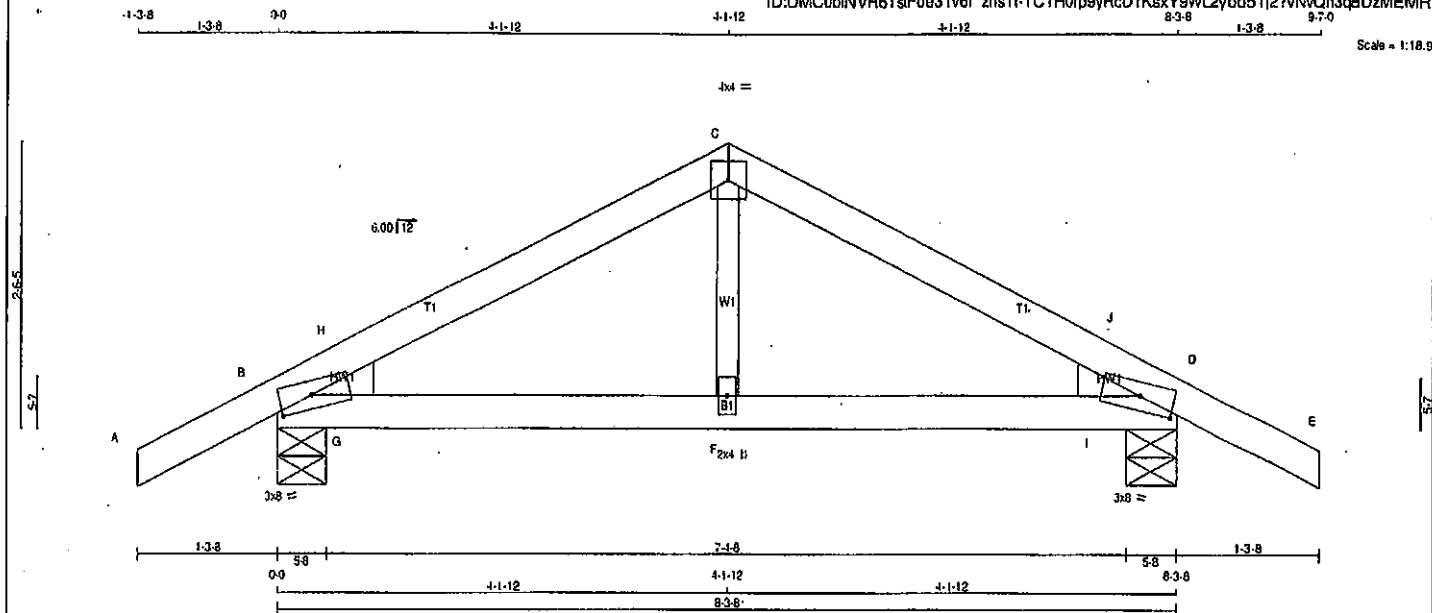

Scale = 1:18.0

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
B - D	2x4	DRY	No.2	SPF
ALL WEBS 2x3 DRY				
DRY: SEASONED LUMBER.				

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMH1-m	MT20	3.0	8.0 1.50 3.75
C	TTW-p	MT20	4.0	4.0
D	TMH1-m	MT20	3.0	8.0 1.50 3.75
F	BMW-w	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS									
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	HEEL WEDGE				
B	582 0	582 0	5-8	5-8	2x4 R				
D	582 0	582 0	5-8	5-8	2x4 R				

UNFACTORED REACTIONS									
JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS							
B	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
D	409	282 0	0 0	0 0	0 0	127 0	0 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)		
FR-TO		FROM	TO	FR-TO					
A-B	0 23	-91.8	-91.8 0.12 (1)	10.00	F-C	0 170	0.04 (1)		
B-H	-539 0	-91.8	-91.8 0.04 (1)	6.25	G-H	-158 3	0.00 (1)		
H-C	-525 0	-91.8	-91.8 0.15 (1)	6.25	I-J	-158 3	0.00 (1)		
C-J	-525 0	-91.8	-91.8 0.15 (1)	6.25					
J-D	-539 0	-91.8	-91.8 0.04 (1)	6.25					
D-E	0 23	-91.8	-91.8 0.12 (1)	10.00					
B-G	0 465	-18.5	-18.5 0.21 (1)	10.00					
G-F	0 465	-18.5	-18.5 0.21 (1)	10.00					
F-I	0 465	-18.5	-18.5 0.21 (1)	10.00					
I-D	0 465	-18.5	-18.5 0.21 (1)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:		
TOP CH.	LL	= 25.6 PSF
	DL	= 6.0 PSF
BOT CH.	LL	= 0.0 PSF
	DL	= 7.4 PSF
TOTAL LOAD = 39.0 PSF		

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCG 2010, NBC 2012, ABC 2019
- PART 9 OF NBCG 2012 (2019 AMENDMENT)
- CSA 080-09, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.28")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.28")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CS1: TC=0.15 (C-J:1), BC=0.21 (F:1), WB=0.04 (I:1), SS=0.12 (J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES				
PLATE GRIP (DRY) SHEAR	SECTION	(PSI)	(PLI)	(PLI)
MAX MIN MAX MIN MAX MIN				
MT20	618	354	1887	788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.25 (B) (INPUT = 0.90)
JSI METAL = 0.11 (B) (INPUT = 1.00)

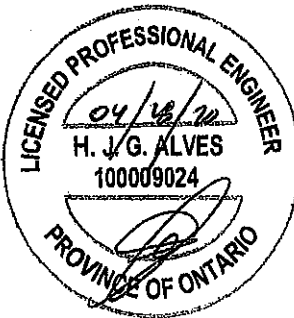

Structural component only
DWG# T-2007646

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG. NO.
408223	G36	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:03:49 2020 Page 1
ID:DMCubINVR6TstFoe31v61_zns11-pdnKxwTznXyK3l8MLaVXNrrubLi5ioKemmYnIzMEMU

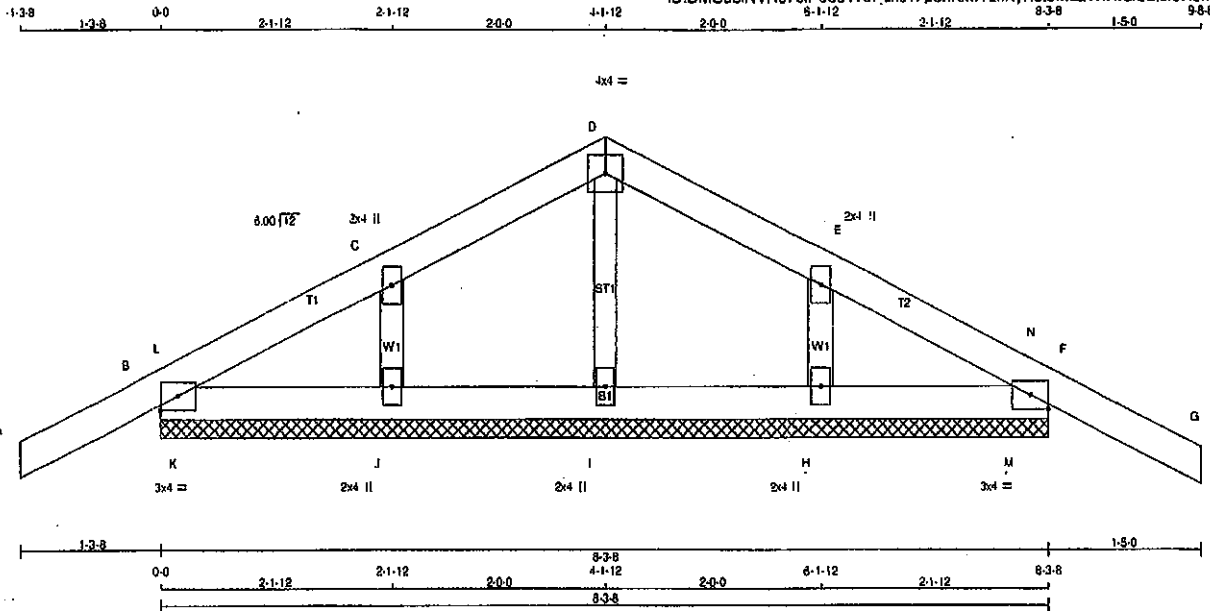

TOTAL WEIGHT = 27 lb
[M]

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
B - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2'-0" O.C.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0		Edge
C	TMW+w	MT20	2.0	4.0		
D	TTW-p	MT20	4.0	4.0		
E	TMW+w	MT20	2.0	4.0		
F	TMB1-I	MT20	3.0	4.0		Edge
H, I, J	BMW1+w	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (L)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (L)	MAX. UNBRACED LENGTH (L)
FR-TO		FROM TO		FR-TO			
A-B	0 23	-91.8 -91.8	0.12 (1)	10.00	I-D	-115 0	0.02 (1)
B-L	-81 0	-91.8 -91.8	0.01 (4)	6.25	J-C	-218 0	0.03 (1)
L-C	-39 0	-91.8 -91.8	0.06 (1)	6.25	H-E	-218 0	0.03 (1)
C-D	-45 0	-91.8 -91.8	0.06 (1)	6.25	K-L	-52 7	0.00 (1)
D-E	-45 0	-91.8 -91.8	0.06 (1)	6.25	M-N	-52 7	0.00 (1)
E-N	-39 0	-91.8 -91.8	0.06 (1)	6.25			
N-F	-81 0	-91.8 -91.8	0.01 (4)	6.25			
F-G	0 25	-91.8 -91.8	0.14 (1)	10.00			
B-K	0 44	-18.5 -18.5	0.03 (1)	10.00			
K-J	0 44	-18.5 -18.5	0.03 (1)	10.00			
J-I	0 32	-18.5 -18.5	0.02 (1)	10.00			
I-H	0 32	-18.5 -18.5	0.02 (1)	10.00			
H-M	0 44	-18.5 -18.5	0.03 (1)	10.00			
M-F	0 44	-18.5 -18.5	0.03 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.14/1.00 (F-G:1) .6C=0.08/1.00 (H-M:1) .WB=0.03/1.00 (E-H:1) .SSI=0.10/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MIN	MAX	MIN
MT20	618	354
	1667	788
	1987	1636

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (B) INPUT = 0.90
JSI METAL = 0.09 (C) INPUT = 1.00



Structural component only
DWG# T-2007621

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	IT37	11	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 MITEX Industries, Inc. Tue Apr 28 10:04:19 2020 Page 1					
ID:DMCubINVR6TstFos31v6l_zns1-xPofEBqnjlk4UR76l1abA7yUR47k72RpNjzMEMQ					
8-5-0					

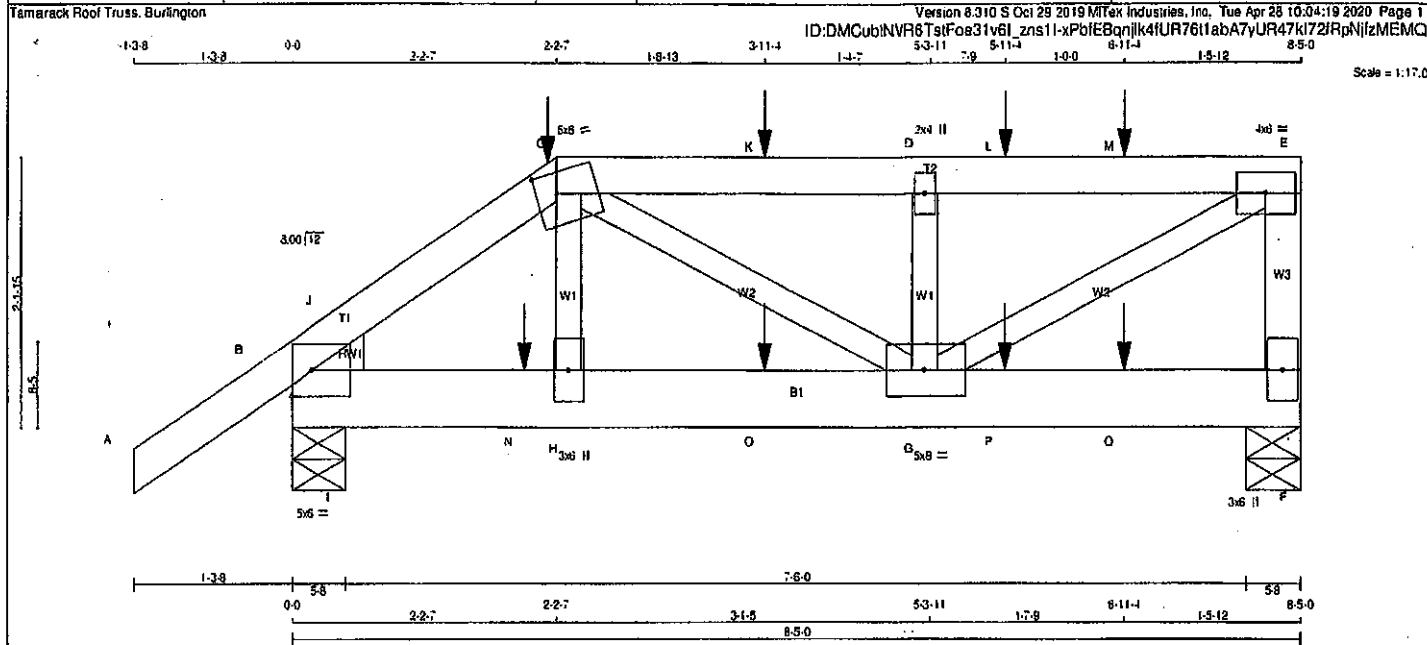

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
F - E	2x4	DRY	No.2
B - F	2x6	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMH1-I	MT20	5.0	6.0 Edge
C	TTWW-m	MT20	5.0	6.0 2.00 2.00
D	TMWW-w	MT20	2.0	4.0
E	TMWW-I	MT20	4.0	6.0
F	BMV1-sp	MT20	3.0	6.0
G	BMWWW-I	MT20	5.0	6.0
H	BMWW-w	MT20	3.0	6.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	HEEL
F	760	0	760	0	5-8
B	823	0	823	0	5-8

UNFACTORED REACTIONS		1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE PERM. LIVE WIND DEAD SOIL
F	537	352.0	0.0 0.0 0.0 185.0 0.0
B	580	392.0	0.0 0.0 0.0 188.0 0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, B

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)		CHORDS	WEBS
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD LC1 MAX (PLF) CSI (LC)	FACTORED VERT. LOAD LC1 MAX (PLF) CSI (LC)
FR-TO		FROM TO	LENGTH FR-TO
A-B	0 26	-91.8 -91.8 0.13 (1)	10.00
B-J	-1068 0	-91.8 -91.8 0.08 (1)	5.99
J-C	-880 0	-91.8 -91.8 0.08 (1)	6.25
C-K	-923 0	-91.8 -91.8 0.24 (1)	6.09
K-D	-923 0	-91.8 -91.8 0.24 (1)	6.09
D-L	-924 0	-91.8 -91.8 0.24 (1)	6.09
L-M	-924 0	-91.8 -91.8 0.24 (1)	6.09
M-E	-924 0	-91.8 -91.8 0.24 (1)	6.09
F-E	-882 0	0.0 0.0 0.08 (1)	7.81
B-I	0 701	-18.5 -18.5 0.14 (1)	10.00
I-N	0 701	-18.5 -18.5 0.14 (1)	10.00
N-H	0 701	-18.5 -18.5 0.14 (1)	10.00
H-O	0 705	-18.5 -18.5 0.15 (1)	10.00
O-G	0 705	-18.5 -18.5 0.15 (1)	10.00
G-P	0 0	-18.5 -18.5 0.07 (1)	10.00
P-O	0 0	-18.5 -18.5 0.07 (1)	10.00
Q-F	0 0	-18.5 -18.5 0.07 (1)	10.00

FACTORED CONCENTRATED LOADS (LBS)		JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	2-2-7	-88	-88	---	FRONT	VERT	TOTAL	---	C1	---	---
K	3-11-4	-83	-83	---	FRONT	VERT	TOTAL	---	C1	---	---
L	5-11-4	-83	-83	---	FRONT	VERT	TOTAL	---	C1	---	---
M	8-11-4	-83	-83	---	FRONT	VERT	TOTAL	---	C1	---	---
N	1-11-4	-48	-48	---	FRONT	VERT	TOTAL	---	C1	---	---
O	3-11-4	-48	-48	---	FRONT	VERT	TOTAL	---	C1	---	---
P	5-11-4	-48	-48	---	FRONT	VERT	TOTAL	---	C1	---	---
Q	8-11-4	-48	-48	---	FRONT	VERT	TOTAL	---	C1	---	---

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2015 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.28")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.28")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")
CSI: TC=0.24,1.00 (D-E:1), BC=0.15,1.00 (G-H:1), WB=0.28,1.00 (E-G:1), SS=0.25,1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.61 (E) (INPUT = 0.90)
JSI METAL= 0.24 (E) (INPUT = 1.00)

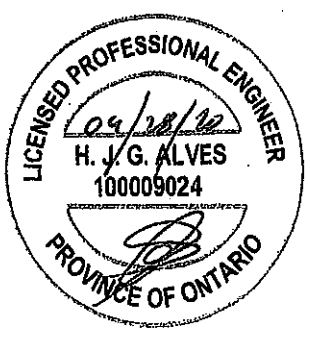

Structural component only
DWG# T-2007647

Tamarack Roof Truss, Burlington


Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:19:57 2020 Page 1

ID:DMCubINVR6TsFos31v61_zns11-TsGG5wA9pyw_Bd8P2IsCzcz_APYAIvTA7LN10dlzME7m

1-3-8 0-0 5-10-8 5-10-8 11-9-6 17-7-0 19-2-12 23-1-10 29-3-8 35-2-0 35-5-8

1-3-8 5-10-8 5-10-14 5-8-10 1-7-12 4-1-14 5-10-14 3-3-8 5-10-8 1-3-8

Scale = 1:57

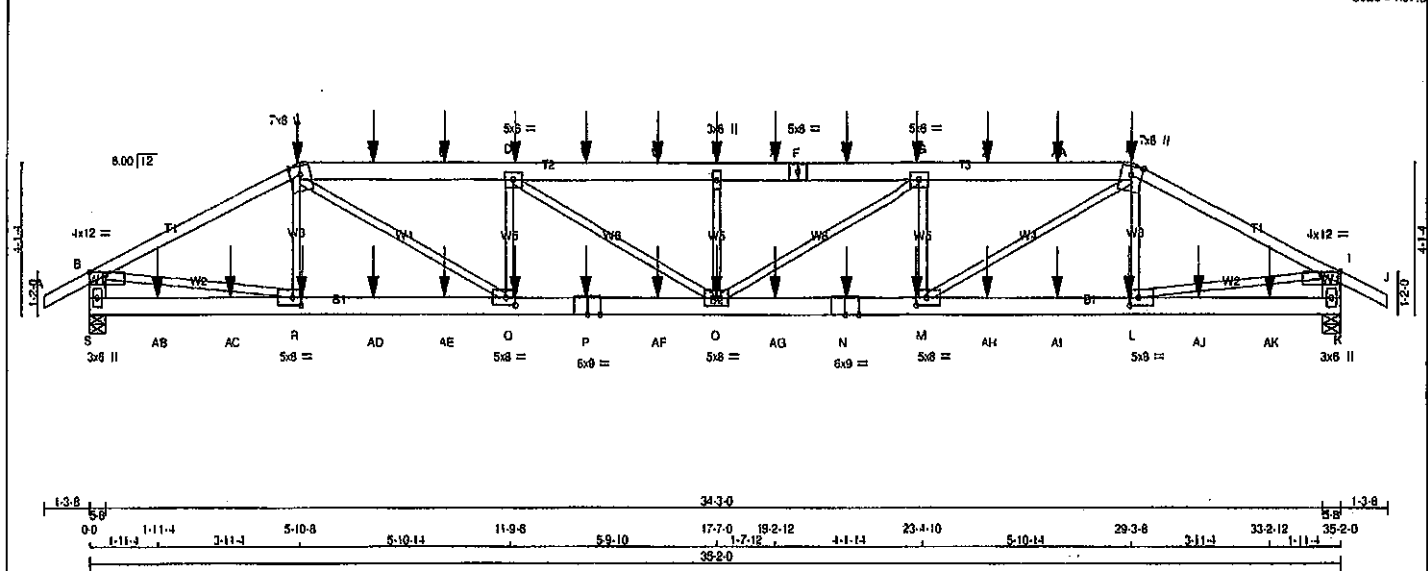[illegible]

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T40	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				Version 8.310 8 Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:19:57 2020 Page 2	
				ID:DMCubINVR6TslFoe31v8I zns1I-TsGG6wA9pyw Bd8P2IsXcz APYAVTa7LN10dlzME7m	

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMWV-p	MT20	4.0	12.0	1.00 5.50
C	TTWW+m	MT20	7.0	8.0	Edge
D	TMWV-l	MT20	5.0	8.0	
E	TMWV-w	MT20	3.0	8.0	
F	TS-l	MT20	5.0	8.0	
G	TMWV-l	MT20	5.0	8.0	
H	TTWW+m	MT20	7.0	8.0	Edge
I	TMWV-p	MT20	4.0	12.0	1.00 5.50
K	BMWV-p	MT20	3.0	8.0	
L	BMWV-l	MT20	5.0	8.0	2.50 3.00
M	BMWV-l	MT20	5.0	8.0	2.50 3.25
N	BS-l	MT20	8.0	9.0	
O	BMWVW-l	MT20	5.0	8.0	
P	BS-l	MT20	6.0	9.0	
Q	BMWV-l	MT20	5.0	8.0	2.50 3.25
R	BMWV-l	MT20	5.0	8.0	2.50 3.00
S	BMV-l-p	MT20	3.0	8.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	17-7-0	-110	-110	---	FRONT	VERT	TOTAL	---	C1
G	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	23-3-8	-229	-429	---	FRONT	VERT	TOTAL	---	C1
L	29-2-12	-28	-26	---	FRONT	VERT	TOTAL	---	C1
M	23-2-12	-28	-26	---	FRONT	VERT	TOTAL	---	C1
N	21-2-12	-28	-26	---	FRONT	VERT	TOTAL	---	C1
O	17-7-0	-28	-28	---	FRONT	VERT	TOTAL	---	C1
P	13-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
Q	11-11-4	-26	-28	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	19-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	21-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	1-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AC	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AD	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AE	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AF	15-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	19-2-12	-28	-26	---	FRONT	VERT	TOTAL	---	C1
AH	25-2-12	-28	-26	---	FRONT	VERT	TOTAL	---	C1
AI	27-2-12	-28	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	31-2-12	-28	-26	---	FRONT	VERT	TOTAL	---	C1
AK	33-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.





Structural component only
DWG# T-2007660

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T40Z	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:19:58 2020 Page 1

ID:DMCubINVR6TstFos31v6l zns11-x2qeJGBoaF2pnjbaNm9BWHeyQ8EpcGa1mZakzME7I

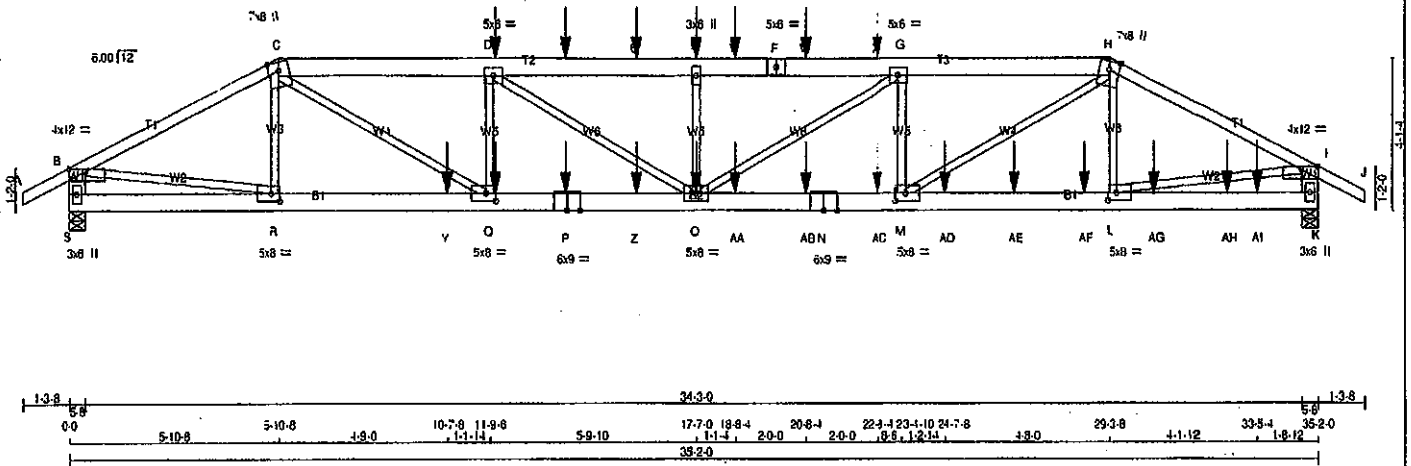

TOTAL WEIGHT = 2 X 169 = 338 LB

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF		
C - F	2x8 DRY	No.2	SPF		
F - H	2x8 DRY	No.2	SPF		
H - J	2x4 DRY	No.2	SPF		
S - B	2x8 DRY	No.2	SPF		
K - I	2x8 DRY	No.2	SPF		
S - P	2x6 DRY	1650F 1.5E	SPF		
P - N	2x8 DRY	1650F 1.5E	SPF		
N - K	2x6 DRY	1650F 1.5E	SPF		
ALL WEBS	2x3 DRY	No.2	SPF		
EXCEPT					

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122'X3") SPIRAL NAILS		
A - C	12	TOP
H - J	12	TOP
C - F	12	SIDE (183.1)
F - H	12	SIDE (0.0)
S - B	12	TOP
K - I	12	TOP
BOTTOM CHORDS : (0.122'X3") SPIRAL NAILS		
S - P	12	SIDE (183.1)
P - N	12	SIDE (183.1)
N - K	12	SIDE (0.0)
WEBS : (0.122'X3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	GROSS REACTION	JT	GROSS REACTION	JT	GROSS REACTION	JT	GROSS REACTION	JT	GROSS REACTION
S	4161 0	S	4161 0	S	4161 0	S	4161 0	S	4161 0
K	5042 0	K	5042 0	K	5042 0	K	5042 0	K	5042 0

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS	1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	JT	COMBINED
S	2936 1985 0 0 0 0 0 0 0 0	S	2936 1985 0 0 0 0 0 0 0 0
K	3552 2409 0 0 0 0 0 0 0 0	K	3552 2409 0 0 0 0 0 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.95 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS1 (LC)
FR-TO		FROM TO	UNBRACED LENGTH	FR-TO			
A-B	0 28	-91.8 -91.8	0.07 (1)	10.00	R-C	-470 0	0.08 (1)
B-C	-8650 0	-91.8 -91.8	0.66 (1)	3.34	C-Q	0 5608	0.89 (1)
C-D	-10735 0	-91.8 -91.8	0.33 (1)	3.55	Q-D	-1678 0	0.20 (1)
D-T	-12119 0	-91.8 -91.8	0.40 (1)	3.30	D-Q	0 1638	0.20 (1)
T-U	-12119 0	-91.8 -91.8	0.40 (1)	3.30	Q-E	-1064 0	0.12 (1)
U-E	-12119 0	-91.8 -91.8	0.40 (1)	3.30	C-G	-46 33	0.02 (1)
E-V	-12119 0	-91.8 -91.8	0.45 (1)	3.23	M-G	-828 0	0.10 (1)
V-F	-12119 0	-91.8 -91.8	0.45 (1)	3.23	M-H	0 5832	0.72 (1)
F-W	-12119 0	-91.8 -91.8	0.45 (1)	3.23	L-H	0 57	0.01 (4)
W-X	-12119 0	-91.8 -91.8	0.45 (1)	3.23	B-R	0 8014	0.74 (1)
X-G	-12119 0	-91.8 -91.8	0.45 (1)	3.23	L-I	0 7274	0.90 (1)
G-H	-12159 0	-91.8 -91.8	0.39 (1)	3.30			
H-I	-8042 0	-91.8 -91.8	0.81 (1)	2.95			
I-J	0 28	-91.8 -91.8	0.07 (1)	10.00			
S-B	-4141 0	0.0 0.0	0.15 (1)	7.00			
K-I	-4926 0	0.0 0.0	0.17 (1)	6.55			

S-R	0 0	-18.5 -18.5 0.05 (1)	10.00
R-Y	0 5974	-18.5 -18.5 0.44 (1)	10.00
Y-Q	0 5974	-18.5 -18.5 0.44 (1)	10.00
Q-P	0 10734	-18.5 -18.5 0.54 (1)	10.00
P-Z	0 10734	-18.5 -18.5 0.54 (1)	10.00
Z-O	0 10734	-18.5 -18.5 0.54 (1)	10.00
O-AA	0 12159	-18.5 -18.5 0.71 (1)	10.00
AA-AB	0 12159	-18.5 -18.5 0.71 (1)	10.00
AB-N	0 12159	-18.5 -18.5 0.71 (1)	10.00
N-AC	0 12159	-18.5 -18.5 0.71 (1)	10.00
AC-M	0 12159	-18.5 -18.5 0.71 (1)	10.00
M-AD	0 7208	-18.5 -18.5 0.69 (1)	10.00
AD-AE	0 7208	-18.5 -18.5 0.69 (1)	10.00
AE-AF	0 7208	-18.5 -18.5 0.69 (1)	10.00
AF-L	0 7208	-18.5 -18.5 0.69 (1)	10.00
L-AG	0 0	-18.5 -18.5 0.18 (1)	10.00
AG-AH	0 0	-18.5 -18.5 0.18 (1)	10.00
AH-AI	0 0	-18.5 -18.5 0.18 (1)	10.00
AI-K	0 0	-18.5 -18.5 0.18 (1)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
D	11-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
E	17-7-0	-110	-110	---	BACK	VERT	TOTAL	---	C1
O	17-7-0	-26	-26	---	BACK	VERT	TOTAL	---	C1
P	13-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019

- PART 9 OF OBC 2012 (2019 AMENDMENT)

- CSA 086-09, CSA 086-14

- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')

CALCULATED VERT. DEFL.(LL) = L/999 (0.32')

ALLOWABLE DEFL.(TL) = L/360 (1.17')

CALCULATED VERT. DEFL.(TL) = L/718 (0.59')

CS1: TC=0.81 1.00 (H-I:1), BC=0.71 1.00 (M-O:1)

WB=0.90 1.00 (L-L:1), SS1=0.64 1.00 (L-M:1)

DOL LUMBER=1.00 NAIL=1.00 L.S BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLD)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1867 788 1897 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (R) (INPUT = 0.90)

JSI METAL = 0.93 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007661

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T40Z	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:19:58 2020 Page 2
ID:DMCubINVR6TstFoe31v6I_zns1l-x2qeJG8oaF2rpnibcaNm9BWHeyQ8EpcGa1mZakzME7l

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	4.0	12.0	1.00	5.50
C	TTWW+m	MT20	7.0	8.0	Edge	
D	TMWW-l	MT20	5.0	6.0		
E	TMW+w	MT20	3.0	6.0		
F	TS-l	MT20	5.0	6.0		
G	TMWW-l	MT20	5.0	6.0		
H	TTWW+m	MT20	7.0	8.0	Edge	
I	TMWV-p	MT20	4.0	12.0	1.00	5.50
K	BMV-l-p	MT20	3.0	6.0		
L	BMWW-l	MT20	5.0	8.0	2.50	3.00
M	BMWW-l	MT20	5.0	8.0	2.50	3.25
N	BS-l	MT20	6.0	9.0		
O	BMWW-l	MT20	5.0	8.0		
P	BS-l	MT20	6.0	9.0		
Q	BMWW-l	MT20	5.0	8.0	2.50	3.25
R	BMWW-l	MT20	5.0	8.0	2.50	3.00
S	BMV-l-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
O	11-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
T	13-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
U	15-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	18-8-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
W	20-8-4	-159	-159	---	BACK	VERT	TOTAL	---	C1
X	22-8-4	-159	-159	---	BACK	VERT	TOTAL	---	C1
Y	10-7-8	-1171	-1171	---	BACK	VERT	TOTAL	---	C1
Z	15-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AA	18-8-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AB	20-8-4	-32	-32	---	BACK	VERT	TOTAL	---	C1
AC	22-8-4	-32	-32	---	BACK	VERT	TOTAL	---	C1
AD	24-7-8	-2237	-2237	---	BACK	VERT	TOTAL	---	C1
AE	28-6-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AF	28-6-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AG	30-6-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AH	32-6-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AI	33-5-4	-121	-121	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2007661

JOB NAME 408224	TRUSS NAME T41	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 5 Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:19:59 2020 Page 1

ID:DMCubINVR6TstFoe31v61 zns11-PFOOWCQLZAIQloAHu7hO3QDMnRzi7PphW7IAzME7k

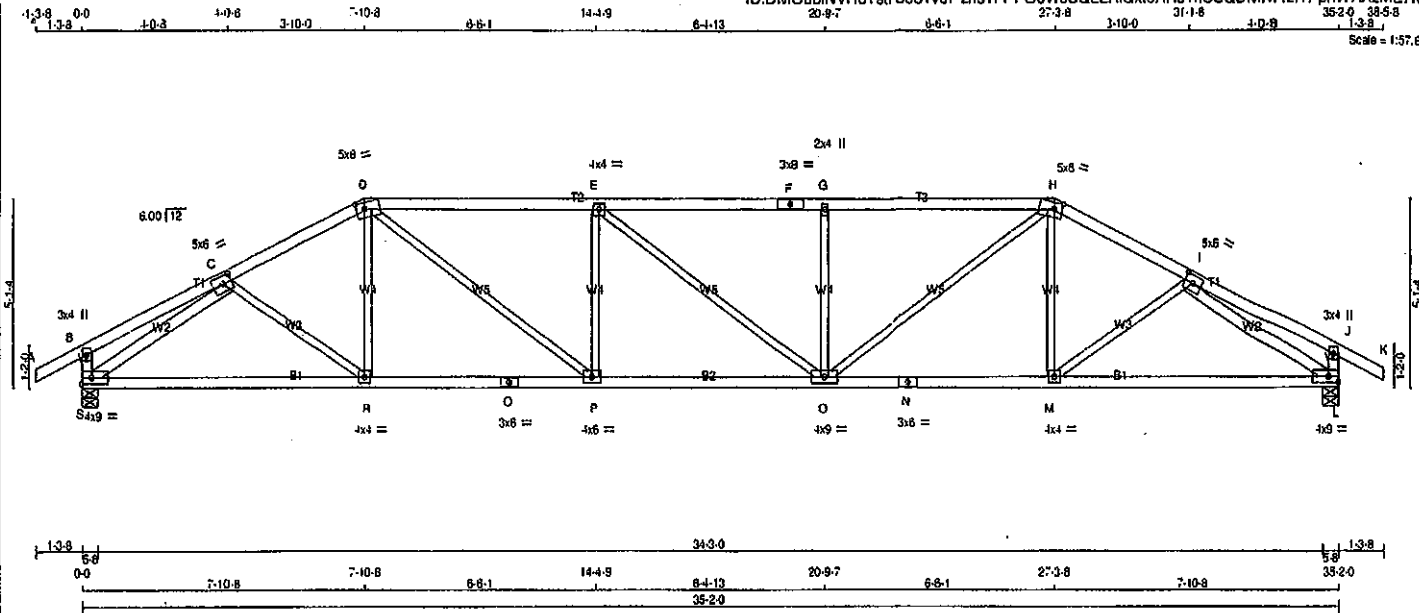

TOTAL WEIGHT = 2 X 139 = 278 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - F	2x4	DRY	No.2	SPF		
F - H	2x4	DRY	No.2	SPF		
H - K	2x4	DRY	No.2	SPF		
S - B	2x4	DRY	No.2	SPF		
L - J	2x4	DRY	No.2	SPF		
S - Q	2x4	DRY	No.2	SPF		
O - N	2x4	DRY	No.2	SPF		
N - L	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						
S - C	2x4	DRY	No.2	SPF		
I - L	2x4	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMVW-I	MT20	5.0	6.0	2.50	2.75
D TTWW-m	MT20	5.0	6.0	2.25	2.75
E TMVW-I	MT20	4.0	4.0		
F TS-I	MT20	3.0	4.0		
G TMVW+m	MT20	2.0	4.0		
H TTWW-m	MT20	5.0	6.0	2.25	2.75
I TMVW-I	MT20	5.0	6.0	2.50	2.75
J TMVW-I	MT20	3.0	4.0		
L BMVW-I	MT20	4.0	9.0		Edge
M BMVW-I	MT20	4.0	4.0		
N BS-I	MT20	3.0	6.0		
O BMVW-I	MT20	4.0	9.0		
P BMVW-I	MT20	4.0	6.0		
Q BS-I	MT20	3.0	6.0		
R BMVW-I	MT20	4.0	4.0		
S BMVW-I	MT20	4.0	9.0		Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION		GROSS REACTION	BRG	BRG
JT VERT	DOWN	DOWN	UPLIFT	IN-SX
S	2063	0	0	5-8
L	2063	0	0	5-8

UNFACTORED REACTIONS

1ST CASE	MAX-MIN. COMPONENT REACTIONS						
JT COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
S	1457	989	0	0	0	0	0
L	1457	989	0	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S. L.

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.94 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED	FORCE	VERT. LOAD	LC1	MAX	MAX.	UNBRAC	WEBS	MEMB.	MAX. FACTORED	FORCE	MAX
			(LBS)			(PLF)	CSI (LC)	LENGTH				(LBS)	CSI (LC)
FR-TO									FR-TO				
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00	C-R	0	93	0.03 (4)			
B-C	0	16	-91.8	-91.8	0.20 (1)	10.00	R-D	0	121	0.04 (4)			
C-D	-2799	0	-91.8	-91.8	0.32 (1)	3.88	D-P	0	1267	0.29 (1)			
D-E	-3508	0	-91.8	-91.8	0.85 (1)	2.94	P-E	-843	0	0.25 (1)			
E-F	-3507	0	-91.8	-91.8	0.93 (1)	2.94	E-O	-2	0	0.00 (1)			
F-G	-3507	0	-91.8	-91.8	0.93 (1)	2.94	O-G	-843	0	0.25 (1)			
G-H	-3507	0	-91.8	-91.8	0.94 (1)	2.95	O-H	0	1268	0.28 (1)			
H-I	-2799	0	-91.8	-91.8	0.32 (1)	3.88	M-H	0	121	0.04 (4)			
I-J	0	16	-91.8	-91.8	0.20 (1)	10.00	M-I	0	93	0.03 (4)			
J-K	0	28	-91.8	-91.8	0.12 (1)	10.00	S-C	-2974	0	0.83 (1)			
S-B	-270	0	0.0	0.0	0.03 (1)	7.81	I-L	-2974	0	0.83 (1)			
L-J	-270	0	0.0	0.0	0.03 (1)	7.81							
S-R	0	2417	-18.5	-18.5	0.53 (1)	10.00							
R-O	0	2489	-18.5	-18.5	0.54 (1)	10.00							
Q-P	0	2489	-18.5	-18.5	0.54 (1)	10.00							
P-O	0	3509	-18.5	-18.5	0.84 (1)	10.00							
O-N	0	2489	-18.5	-18.5	0.54 (1)	10.00							
N-M	0	2489	-18.5	-18.5	0.54 (1)	10.00							
M-L	0	2417	-18.5	-18.5	0.53 (1)	10.00							

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBCG 2018, CBC 2012, ABC 2019
- PART 9 OF ORC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.21')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.41')

CSI: TC=0.85 (1.00) (D-E:1), BC=0.64 (1.00) (O-P:1),
WB=0.83 (1.00) (I-L:1), SS=0.28 (1.00) (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR	SECTION	(PSI)	(PLI)	(PLI)
MAX MIN MAX MIN MAX MIN				
MT20	618	354	1887	768
			1987	1856

PLATE PLACEMENT TOL = 0.250 inches



PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (I); (INPUT = 0.90)
JSI METAL = 0.77 (N); (INPUT = 1.00)



Structural component only
DWG# T-2007662

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T42	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:20:01 2020 Page 1			
		ID:DMCubINVR6TstFos31v6l_zns1f-LdWnxHEgtAQpQFSAHixTmP8IJ9V7RFJIG?En3zME7			

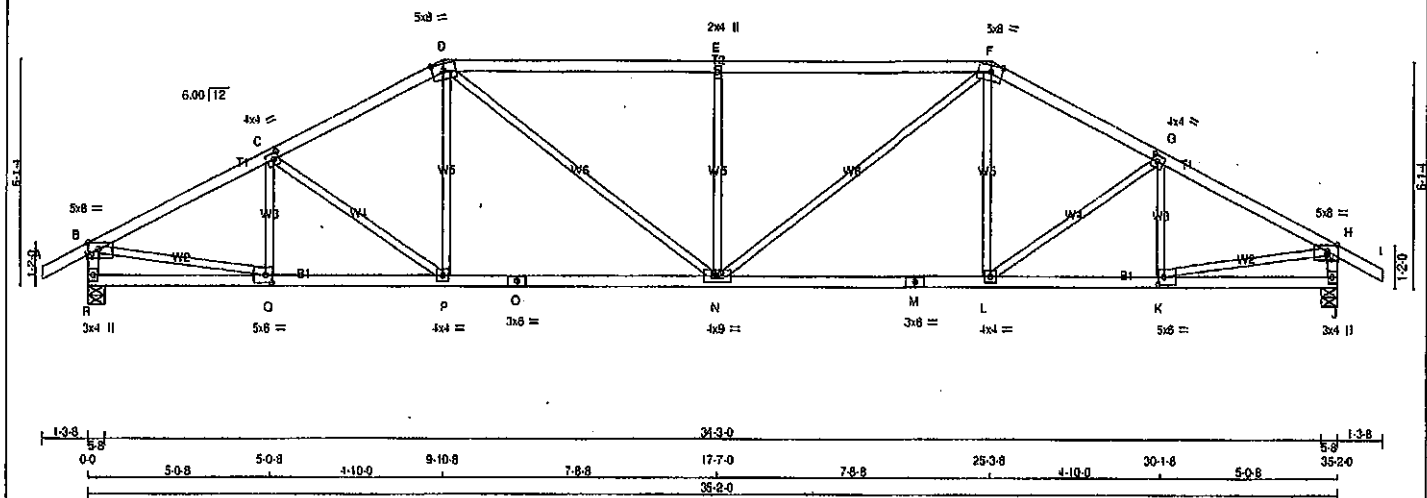

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - O	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - I	2x4	DRY	No.2	SPF	
R - B	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
R - O	2x4	DRY	No.2	SPF	
O - M	2x4	DRY	No.2	SPF	
M - J	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	3.50
C	TMVW-l	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	8.0	2.25	3.75
E	TMVW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	8.0	2.25	3.75
G	TMVW-l	MT20	4.0	4.0	2.00	1.75
H	TMVW-p	MT20	5.0	8.0	Edge	3.50
J	BMV1-p	MT20	3.0	4.0		
K	BMVW-l	MT20	5.0	8.0	2.50	2.00
L	BMVW-l	MT20	4.0	4.0		
M	BS-l	MT20	3.0	8.0		
N	BMVW-w	MT20	4.0	4.0		
O	BS-l	MT20	3.0	8.0		
P	BMVW-l	MT20	4.0	4.0		
Q	BMVW-l	MT20	5.0	8.0	2.50	2.00
R	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG.	BRG.
JT	VERT	HORZ	UPLIFT	IN-SX
R	2063	0	0	5-8
J	2063	0	0	5-8

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1457	989	0	0	0	488	0
J	1457	989	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.78 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0 28	-91.8 -91.8 0.12 (1)	Q-C	-353 0
B-C	-2834 0	-91.8 -91.8 0.39 (1)	C-P	-210 0
C-D	-2867 0	-91.8 -91.8 0.37 (1)	P-D	0 246
D-E	-3080 0	-91.8 -91.8 0.97 (1)	D-N	0 844
E-F	-3080 0	-91.8 -91.8 0.97 (1)	N-E	-872 0
F-G	-2867 0	-91.8 -91.8 0.37 (1)	N-F	0 844
G-H	-2834 0	-91.8 -91.8 0.39 (1)	L-F	0 246
H-I	0 28	-91.8 -91.8 0.12 (1)	L-G	-210 0
I-B	-2018 0	0.0 0.0 0.20 (1)	K-C	-353 0
J-H	-2018 0	0.0 0.0 0.20 (1)	B-Q	0 2591
			K-H	0 2591
R-Q	0 0	-18.5 -18.5 0.10 (4)		
O-P	0 2555	-18.5 -18.5 0.51 (1)		
P-O	0 2386	-18.5 -18.5 0.49 (1)		
O-N	0 2386	-18.5 -18.5 0.49 (1)		
N-M	0 2386	-18.5 -18.5 0.49 (1)		
M-L	0 2386	-18.5 -18.5 0.49 (1)		
L-K	0 2555	-18.5 -18.5 0.51 (1)		
K-J	0 0	-18.5 -18.5 0.10 (4)		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.0/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.17")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.34")

CSI: TC=0.97 (1.00 (D-E:1)), BC=0.51 (1.00 (P-O:1)),
WB=0.58 (1.00 (B-Q:1)), SSI=0.34 (1.00 (D-E:1))

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (F) (INPUT = 0.90)
JSI METAL = 0.75 (M) (INPUT = 1.00)




Structural component only
DWG# T-2007663

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T43	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 26 10:20:02 2020 Page 1
ID:DMCubINVR6TstFoe31v81_zns11-qd498dEleUYGHOINrQSIJ1h7BZVAIOsViknJVzME7h

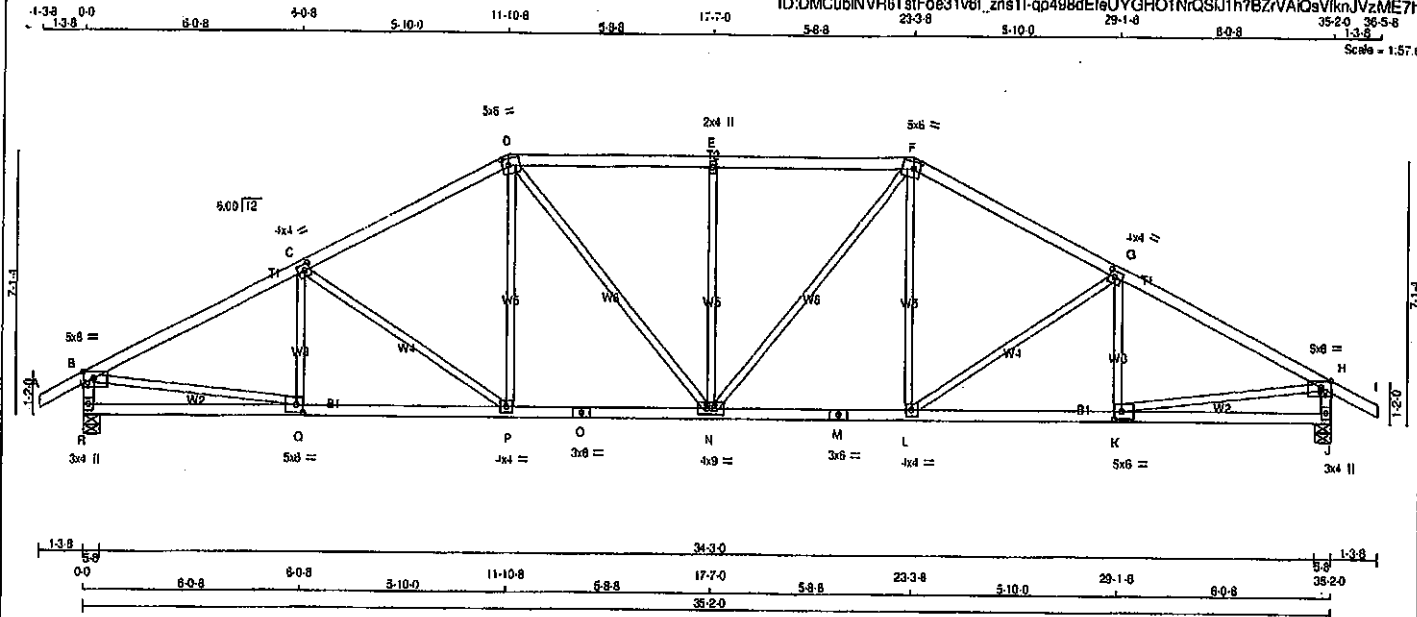

CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
J - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT
DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG
R	VERT	DOWN	HORIZ	UPLIFT
J	2063	0	0	5-8
J	2063	0	0	5-8

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED
R	1457 989 0 0 0 0 0 0 488 0 0 0
J	1457 989 0 0 0 0 0 0 488 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED	FACTORED	FACTORED		MAX. FACTORED	FACTORED		
MEMB.	FORCE	VERT. LOAD	LC1	MEMB.	FORCE	MAX	
(LBS)	(PLF)	CSI (LC)	UNBRAC	(LBS)	MAX	CSI (LC)	
FR-TO	FROM	TO	LENGTH	FR-TO	FROM	TO	
A-B	0	28	-91.8 -91.8 0.12 (1)	10.00	Q-C	-255 12	0.07 (1)
B-C	-2809	0	-91.8 -91.8 0.58 (1)	3.58	C-P	-435 0	0.42 (1)
C-D	-2539	0	-91.8 -91.8 0.52 (1)	3.83	P-D	0 350	0.08 (1)
D-E	-2559	0	-91.8 -91.8 0.48 (1)	3.85	D-N	0 482	0.11 (1)
E-F	-2559	0	-91.8 -91.8 0.48 (1)	3.85	N-E	-641 0	0.56 (1)
F-G	-2539	0	-91.8 -91.8 0.52 (1)	3.83	N-F	0 482	0.11 (1)
G-H	-2809	0	-91.8 -91.8 0.58 (1)	3.58	L-F	0 350	0.08 (1)
H-I	0	28	-91.8 -91.8 0.12 (1)	10.00	L-G	-435 0	0.42 (1)
I-R	-2014	0	0.0 0.0 0.20 (1)	5.95	K-G	-255 12	0.07 (1)
J-H	-2014	0	0.0 0.0 0.20 (1)	5.95	B-Q	0 2635	0.59 (1)
					K-H	0 2635	0.59 (1)
R-Q	0	0	-18.5 -18.5 0.15 (4)	10.00			
Q-P	0	2809	-18.5 -18.5 0.49 (1)	10.00			
P-O	0	2249	-18.5 -18.5 0.43 (1)	10.00			
O-N	0	2249	-18.5 -18.5 0.43 (1)	10.00			
N-M	0	2249	-18.5 -18.5 0.43 (1)	10.00			
M-L	0	2249	-18.5 -18.5 0.43 (1)	10.00			
L-K	0	2809	-18.5 -18.5 0.49 (1)	10.00			
K-J	0	0	-18.5 -18.5 0.15 (4)	10.00			

TOTAL WEIGHT = 2 X 145 = 289 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.15")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.28")

CSI: TC=0.58/1.00 (G-H:1), BC=0.49/1.00 (K-L:1), WB=0.59/1.00 (H-K:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MT20	618	354
	1887	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (Q) INPUT = 0.90
JSI METAL= 0.69 (M) INPUT = 1.00



Structural component only
DWG# T-2007664

JOB NAME 408224	TRUSS NAME T44	QUANTITY 2	PLV 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:20:03 2020 Page 1	
ID:DMCubINVR8TstF0e31v6I zns1I-I0dXMzFwOog7vYcZP7xsEE72zACv9c7kLUKxzME7g				35-2-0 36-5-8	
Scale = 1:50.0					

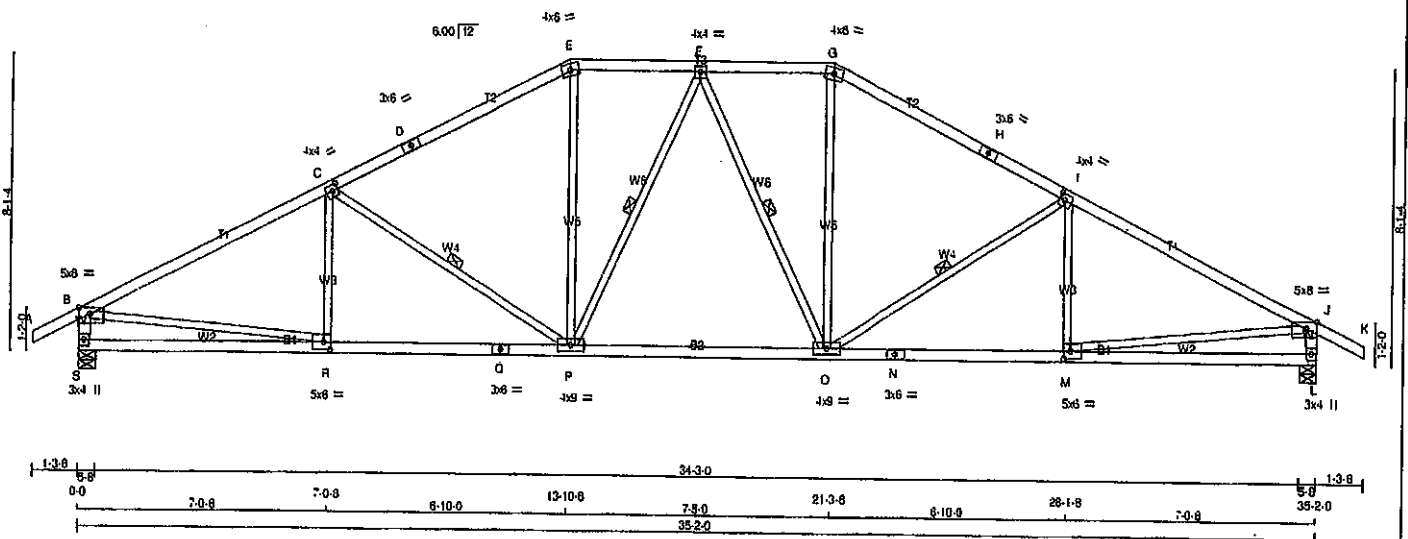

TOTAL WEIGHT = 2 X 145 = 291 lb
(M/F)

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
K - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
SPF			

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	3.50
C	TMVW-t	MT20	4.0	4.0	2.00	1.75
D	TS-t	MT20	3.0	6.0		
E	TTW-m	MT20	4.0	8.0		
F	TMVW-t	MT20	4.0	4.0		
G	TTW-m	MT20	4.0	8.0		
H	TS-t	MT20	3.0	6.0		
I	TMVW-t	MT20	4.0	4.0	2.00	1.75
J	TMVW-p	MT20	5.0	8.0	Edge	3.50
L	BMV1-p	MT20	3.0	4.0		
M	BMVW-t	MT20	5.0	6.0	2.50	2.25
N	BS-t	MT20	3.0	6.0		
O	BMVW-t	MT20	4.0	9.0		
P	BMVW-t	MT20	4.0	9.0		
Q	BS-t	MT20	3.0	6.0		
R	BMVW-t	MT20	5.0	6.0	2.50	2.25
S	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG	
S	VERT	2063	0	0	5-8
L	HORIZ	2063	0	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	COMBINED	1457	989	0	0	0	488	0
L	COMBINED	1457	989	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-P, F-P, F-O, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	UNBRAC	FR-TO	MEMB.	MAX. FACTORED	FORCE	MAX
MEMB.	FORCE	(LBS)	(PLF)	(PLF)	(LBS)	(LBS)	LENGTH	FR-TO	MEMB.	FORCE	(LBS)	CS(I/O)
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00	R-C	-182	52	0.08 (1)		
B-C	-2808	0	-91.8	-91.8	0.83 (1)	3.25	C-P	-637	0	0.29 (1)		
C-D	-2373	0	-91.8	-91.8	0.72 (1)	3.66	P-E	0	674	0.15 (1)		
D-E	-2373	0	-91.8	-91.8	0.72 (1)	3.66	F-F	-222	0	0.11 (1)		
E-F	-2100	0	-91.8	-91.8	0.19 (1)	4.53	F-O	-222	0	0.11 (1)		
F-G	-2100	0	-91.8	-91.8	0.19 (1)	4.53	O-G	0	674	0.15 (1)		
G-H	-2373	0	-91.8	-91.8	0.72 (1)	3.66	O-I	-637	0	0.29 (1)		
H-I	-2373	0	-91.8	-91.8	0.72 (1)	3.66	M-I	-182	52	0.08 (1)		
I-J	-2808	0	-91.8	-91.8	0.83 (1)	3.25	B-R	0	2649	0.80 (1)		
J-K	0	28	-91.8	-91.8	0.12 (1)	10.00	M-J	0	2649	0.60 (1)		
S-B	-2008	0	0.0	0.0	0.20 (1)	5.96						
L-J	-2008	0	0.0	0.0	0.20 (1)	5.96						
S-R	0	0	-18.5	-18.5	0.20 (4)	10.00						
R-Q	0	2630	-18.5	-18.5	0.52 (1)	10.00						
Q-P	0	2630	-18.5	-18.5	0.52 (1)	10.00						
P-Q	0	2193	-18.5	-18.5	0.45 (1)	10.00						
Q-N	0	2630	-18.5	-18.5	0.52 (1)	10.00						
N-M	0	2630	-18.5	-18.5	0.52 (1)	10.00						
M-L	0	0	-18.5	-18.5	0.20 (4)	10.00						

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 0.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.30")

CS: TC=0.83/1.00 (I-J:1), BC=0.52/1.00 (M-O:1), WB=0.60/1.00 (J-M:1), SS=0.28/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (M) (INPUT = 0.80)
JSI METAL = 0.79 (Q) (INPUT = 1.00)

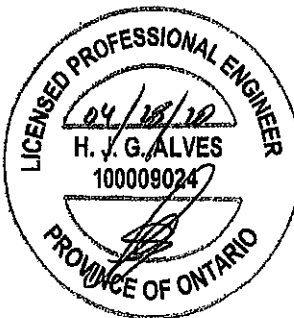

Structural component only
DWG# T-2007665

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T45	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:20:04 2020 Page 1			
		ID:DMCubINVR8TslFoe31v6l_zns11-mCBvZJGY95o_XiB1zUBOSmOWNWqecdyDuNOzME7/			
		35-2-0 28-5-8 1-3-8			
		Scale = 1:58.3			

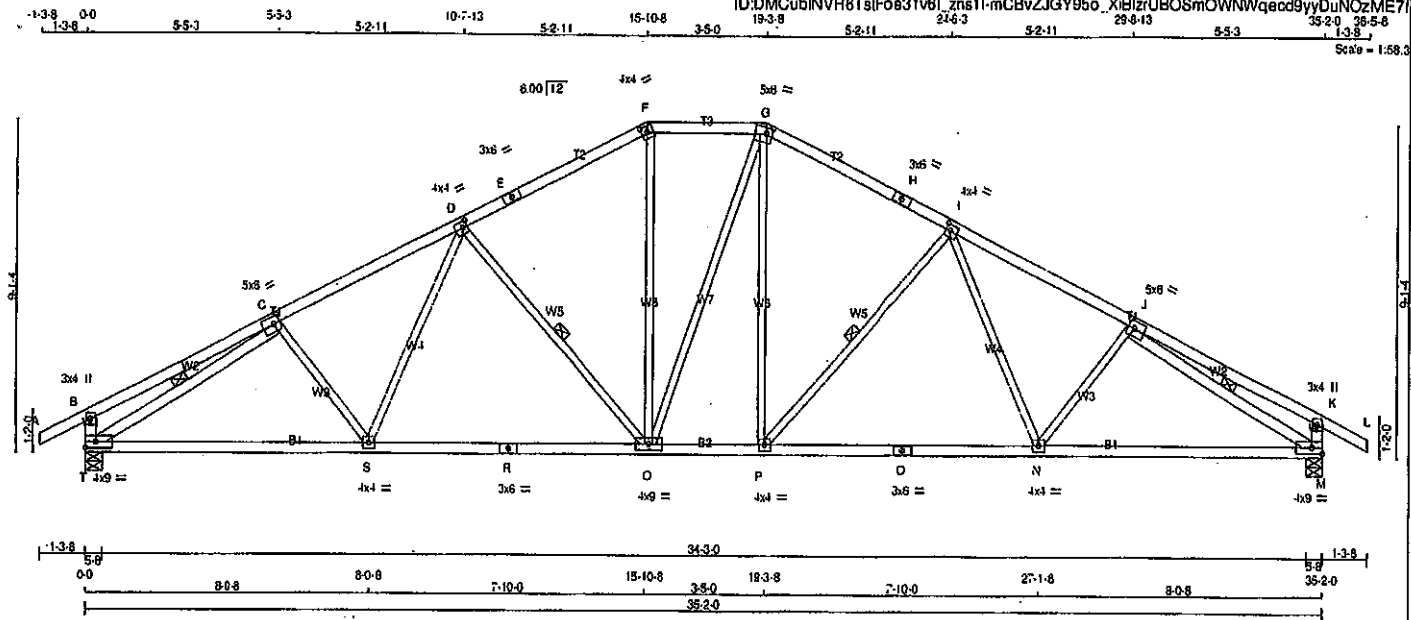

LUMBER			
N. L. G. A. RULES	CHOROS	SIZE	LUMBER
A - E	2x4	DRY	No.2
F - G	2x4	DRY	No.2
H - I	2x4	DRY	No.2
J - K	2x4	DRY	No.2
L - M	2x4	DRY	No.2
N - O	2x4	DRY	No.2
P - Q	2x4	DRY	No.2
R - S	2x4	DRY	No.2
T - U	2x4	DRY	No.2
V - W	2x4	DRY	No.2
X - Y	2x4	DRY	No.2
Z - M	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2 SPF			
EXCEPT			
T - C	2x4	DRY	No.2
J - M	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVap	MT20	3.0	4.0	
C	TMVW-i	MT20	5.0	6.0	2.50 2.25
D	TMVW-i	MT20	4.0	4.0	2.00 1.50
E	TS-i	MT20	3.0	6.0	
F	TTW-h	MT20	4.0	4.0	2.00 1.75
G	TTW-m	MT20	5.0	6.0	2.00 2.00
H	TS-i	MT20	3.0	6.0	
I	TMVW-i	MT20	4.0	4.0	2.00 1.50
J	TMVW-i	MT20	5.0	6.0	2.50 2.25
K	TMVap	MT20	3.0	4.0	
M	BMVW-i	MT20	4.0	9.0	Edge
N. P. S.					
N	BMVW-i	MT20	4.0	4.0	
O	BS-i	MT20	3.0	6.0	
Q	BMVW-i	MT20	4.0	9.0	
R	BS-i	MT20	3.0	6.0	
T	BMVW-i	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX
T	2063	0	0	2063	0	0	5-8	5-8	5-8
M	2063	0	0	2063	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST LCASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
T	1457	989	0	0	0
M	1457	989	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.88 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1:2 LENGTH OF D-Q, I-P, C-T, J-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0 28	C-S	-110 37
B-C	0 20	S-D	0 276
C-D	-2760 0	D-Q	-682 0
D-E	-2187 0	Q-F	0 614
E-F	-2187 0	F-G	0 4
F-G	-1925 0	G-H	0 609
G-H	-2185 0	H-I	-683 0
H-I	-2185 0	I-N	0 279
I-J	-2761 0	N-J	-110 37
J-K	0 20	T-C	-3042 0
K-L	0 28	J-M	-3043 0
T-B	-325 0		
M-K	-325 0		
T-S	0 2537		
S-R	0 2363		
R-Q	0 2363		
Q-P	0 1924		
P-O	0 2362		
O-N	0 2362		
N-M	0 2538		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF 8CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.29")

CSI: TC=0.40/1.00 (I-I), BC=0.58/1.00 (M-N), WB=0.61/1.00 (J-M), SS=0.20/1.00 (G-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1858

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (F) (INPUT = 0.90)
JSI METAL = 0.83 (O) (INPUT = 1.00)




Structural component only
DWG# T-2007666

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T46	8	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTak Industries, Inc. Tue Apr 28 10:20:05 2020 Page 1
ID:DMCubINVR6TstF0e31v8l zns1l-EOlinHbWpW9smyWY?QxIJYonsaN17IBczRwqzME76

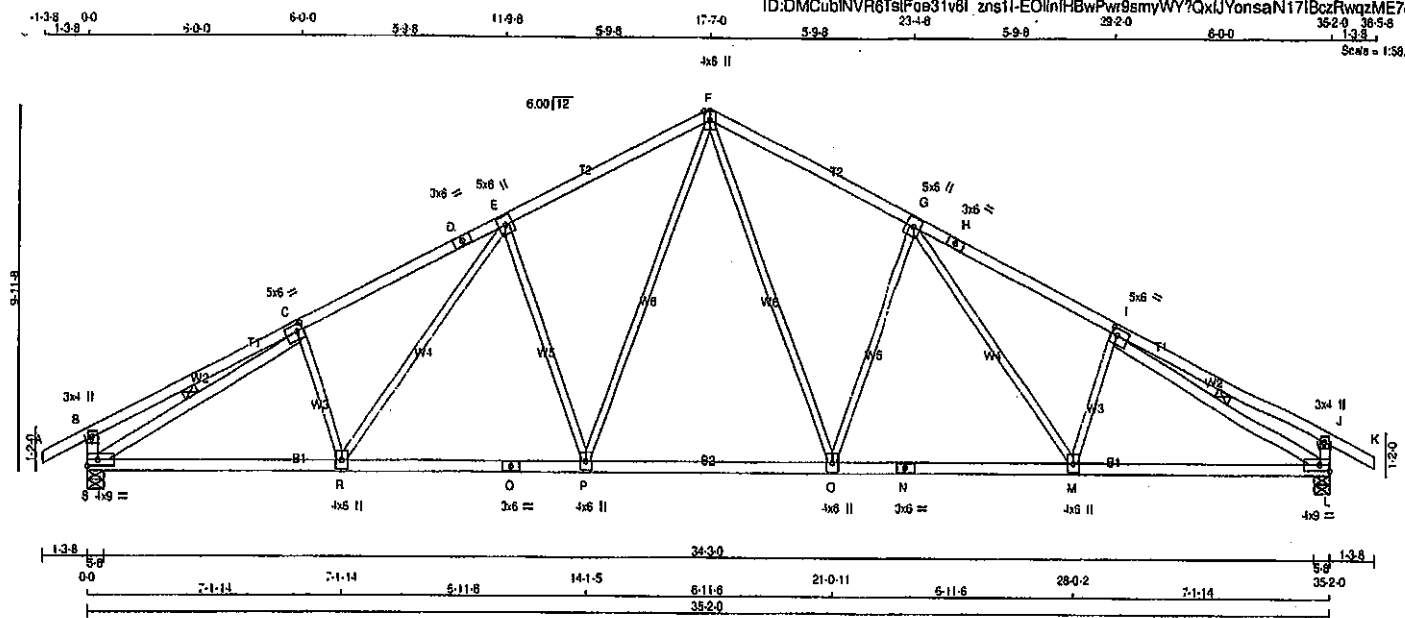

TOTAL WEIGHT = 8 X 152 = 1213 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
E - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - K	2x4	DRY	No.2	SPF	
S - B	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
S - Q	2x4	DRY	No.2	SPF	
Q - N	2x4	DRY	No.2	SPF	
N - L	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	
S - C	2x4	DRY	No.2	SPF	
I - L	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW+1	MT20	5.0	6.0	2.25	2.00
D	TS-1	MT20	3.0	6.0		
E	TMWW+1	MT20	5.0	6.0		
F	TTWW+p	MT20	4.0	6.0	Edge	
G	TMWW+1	MT20	5.0	6.0		
H	TS-1	MT20	3.0	6.0		
I	TMWW+1	MT20	5.0	6.0	2.25	2.00
J	TMV+p	MT20	3.0	4.0		
L	BMVW1-1	MT20	4.0	9.0	Edge	
M, O, P, R						
M	BMVW+1	MT20	4.0	6.0		
N	BS-1	MT20	3.0	6.0		
Q	BS-1	MT20	3.0	6.0		
S	BMVW1-1	MT20	4.0	9.0	Edge	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

READINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	IN-SX	IN-SX
S	2063	0	5-8	5-8
L	2063	0	5-8	5-8

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW				
S	1457	989.0	0.0	0.0	0.0	488.0
L	1457	989.0	0.0	0.0	0.0	488.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-S, I-L

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	UNBRACED LENGTH	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 28	-91.8 -91.8	0.12 (1)	10.00	P-O	0 866	0.19 (1)
B-C	0 22	-91.8 -91.8	0.40 (1)	10.00	O-G	-728 0	0.72 (1)
C-D	-2808 0	-91.8 -91.8	0.49 (1)	3.75	G-M	0 391	0.09 (1)
D-E	-2808 0	-91.8 -91.8	0.49 (1)	3.75	M-I	-192 18	0.05 (1)
E-F	-2322 0	-91.8 -91.8	0.48 (1)	4.07	P-F	0 866	0.19 (1)
F-G	-2322 0	-91.8 -91.8	0.48 (1)	4.07	E-P	-728 0	0.72 (1)
G-H	-2808 0	-91.8 -91.8	0.49 (1)	3.75	R-E	0 391	0.09 (1)
H-I	-2808 0	-91.8 -91.8	0.49 (1)	3.75	C-R	-192 18	0.05 (1)
I-J	0 22	-91.8 -91.8	0.40 (1)	10.00	S-C	-3084 0	0.72 (1)
J-K	0 28	-91.8 -91.8	0.12 (1)	10.00	I-L	-3084 0	0.72 (1)
S-B	-344 0	0.0 0.0	0.03 (1)	7.61			
L-J	-344 0	0.0 0.0	0.03 (1)	7.61			
S-R	0 2574	-18.5 -18.5	0.53 (1)	10.00			
R-O	0 2291	-18.5 -18.5	0.47 (1)	10.00			
O-P	0 2291	-18.5 -18.5	0.47 (1)	10.00			
P-O	0 1762	-18.5 -18.5	0.38 (1)	10.00			
O-N	0 2291	-18.5 -18.5	0.47 (1)	10.00			
N-M	0 2291	-18.5 -18.5	0.47 (1)	10.00			
M-L	0 2574	-18.5 -18.5	0.53 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 8 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 089-09, CSA 088-14
- TPIC 2011, TPIC 2014

65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.28")

CSI: TC=0.49/1.00 (C-E:1), BC=0.53/1.00 (L-M:1),
WB=0.72/1.00 (E-P:1), SI=0.22/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 6.0 Deg.

JSI GRIP = 0.87 (C) (INPUT = 0.90)
JSI METAL = 0.77 (I) (INPUT = 1.00)

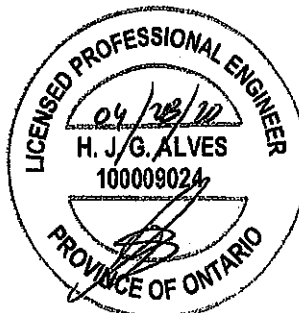


Structural component only
DWG# T-2007667

JOB NAME 408224	TRUSS NAME T47S	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	----------

Yamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:20:06 2020 Page 1
ID:DMCubINVR6TslFoe31v6l zns1l-bJq_7Hphj2lm0K4GWttsngAdw6c_RQGi_SGzME7d

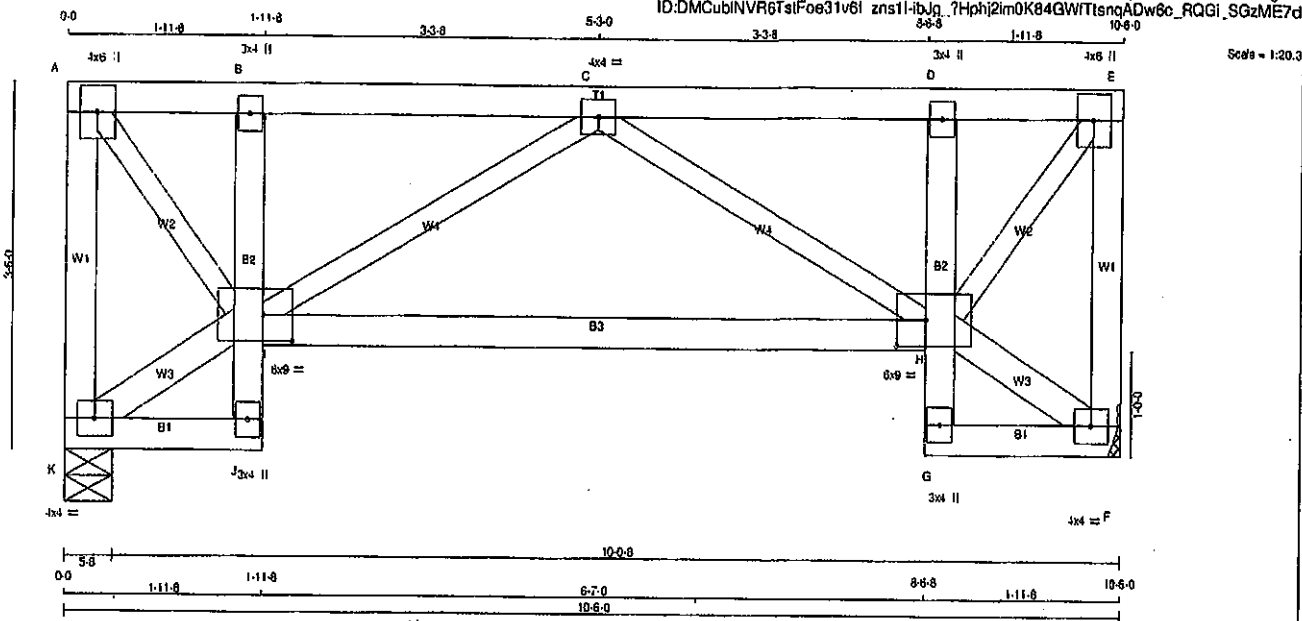

TOTAL WEIGHT = 2 X 51 = 102 lb (M/R)

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
K - A	2x4	DRY	No.2
A - E	2x4	DRY	No.2
F - E	2x4	DRY	No.2
K - J	2x4	DRY	No.2
J - B	2x4	DRY	No.2
I - H	2x4	DRY	No.2
G - D	2x4	DRY	No.2
G - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
K - I	2x4	DRY	No.2
H - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	6.0		
B	TMV+p	MT20	3.0	4.0		
C	TMVW-1	MT20	4.0	4.0		
D	TMV+p	MT20	3.0	4.0		
E	TMVW+p	MT20	4.0	6.0		
F	BMVW-1	MT20	4.0	4.0		
G	BMV+p	MT20	3.0	4.0		
H	BVMW-1	MT20	6.0	9.0	3.00	3.50
I	BVMW-1	MT20	6.0	9.0	3.00	3.50
J	BMV+p	MT20	3.0	4.0		
K	BMVW-1	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING BEARINGS

JT	FACTORED		MAXIMUM FACTORED		INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG		
K	697	0	697	0	5-8	5-8
F	697	0	697	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST LOSE	MAX. MIN. COMPONENT REACTIONS					
K	504	269 0	0 0	0 0	0 0	235 0	0 0
F	504	269 0	0 0	0 0	0 0	235 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 0.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.61 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
K-A	-667 0	0.0 0.0 0.17 (1)	7.81	K-I	-28 0	0.00 (1)	
A-B	-497 0	-114.3 -114.3 0.14 (1)	6.25	A-I	0 783	0.24 (1)	
B-C	-508 0	-114.3 -114.3 0.22 (1)	6.25	H-F	-28 0	0.00 (1)	
C-D	-508 0	-114.3 -114.3 0.22 (1)	6.25	H-E	0 783	0.24 (1)	
D-E	-497 0	-114.3 -114.3 0.14 (1)	6.25	I-C	-384 0	0.15 (1)	
E-F	-687 0	0.0 0.0 0.17 (1)	7.81	C-H	-384 0	0.15 (1)	
K-J	0 25	-18.5 -18.5 0.03 (4)	10.00				
J-I	0 19	0.0 0.0 0.05 (1)	10.00				
I-B	-331 0	0.0 0.0 0.05 (1)	7.81				
I-H	0 832	-18.5 -18.5 0.48 (4)	10.00				
G-H	0 19	0.0 0.0 0.05 (1)	10.00				
H-D	-331 0	0.0 0.0 0.05 (1)	7.81				
G-F	0 25	-18.5 -18.5 0.03 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL = 15.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.4	PSF	
TOTAL LOAD	= 48.0	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

ISS % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.22/1.00 (B-C:1), BC=0.46/1.00 (H-I:1), WB=0.24/1.00 (E-H:1), SS=0.22/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.77 (H) (INPUT = 0.90)
JSI METAL = 0.30 (E) (INPUT = 1.00)



Structural component only
DWG# T-2007668

JOB NAME 408224	TRUSS NAME T48	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Tue Apr 28 10:20:07 2020 Page 1
ID:DMCubINVR6TstFoe31v6I zns11-Ani2CLIRS0AZOAvKoz1u04OyjadN3HbWsy izME7c
6-7-12 6-8-8 0-12 3-9-8 10-6-0
Scale = 1:18.2

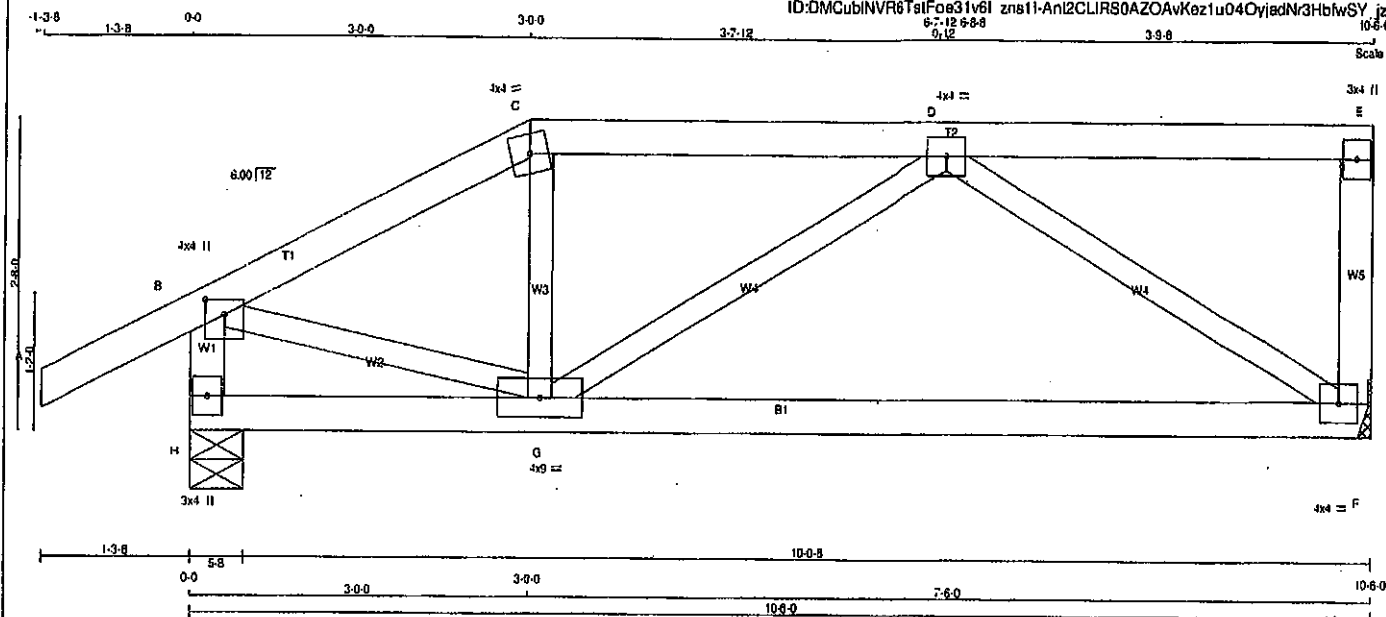

TOTAL WEIGHT = 40 lb (M)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - E	2x4	DRY	No.2	SPF		
F - E	2x4	DRY	No.2	SPF		
H - B	2x4	DRY	No.2	SPF		
H - F	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						
DRY: SEASONED LUMBER.						

PLATES (table in inches)	W	LEN	Y	X
JT TYPE PLATES				
B TMWV+p	MT20	4.0	4.0	1.50 2.00
C TTW-m	MT20	4.0	4.0	
D TMWV-l	MT20	4.0	4.0	
E TMV-p	MT20	3.0	4.0	
F BMVW1-l	MT20	4.0	4.0	
G BMWVW-l	MT20	4.0	9.0	
H BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REORD
GROSS REACTION	GROSS REACTION	BRG	BRG	
JT VERT	DOWN	HORZ	UPLIFT	IN-SX
F 579 0	579 0	0	MECHANICAL	
H 703 0	703 0	0	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

1ST CASE	MAX./MIN. COMPONENT REACTIONS						
JT COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
F 409	269 0	0 0	0 0	0 0	141 0	0 0	
H 495	338 0	0 0	0 0	0 0	157 0	0 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO	CS1 (LC)	FR-TO		
A-B	0 28	-91.8 -91.8 0.12 (1)	10.00	G-C	0 61	0.02 (4)
B-C	-635 0	-91.8 -91.8 0.15 (1)	6.25	G-D	-81 80	0.02 (4)
C-D	-689 0	-91.8 -91.8 0.21 (1)	6.25	D-F	-731 0	0.23 (1)
D-E	0 0	-91.8 -91.8 0.20 (1)	10.00	B-G	0 587	0.13 (1)
F-E	-135 0	0.0 0.0 0.02 (1)	7.81			
H-B	-699 0	0.0 0.0 0.07 (1)	7.81			
H-G	0 0	-18.5 -18.5 0.21 (4)	10.00			
G-F	0 619	-18.5 -18.5 0.25 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L 999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L 999 (0.09")

CS1: TC=0.21/1.00 (C-D:1), BC=0.25/1.00 (F-G:4), WB=0.29/1.00 (D-F:1), SS1=0.17/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.68 (B) (INPUT = 0.90)
JSI METAL= 0.23 (F) (INPUT = 1.00)

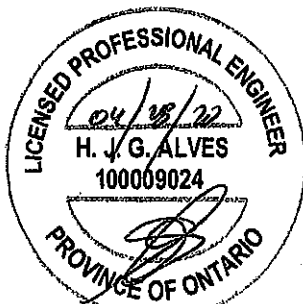


Structural component only
DWG# T-2007669

JOB NAME 408224	TRUSS NAME T49	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:20:08 2020 Page 1

ID:DMCubiNVR6TslFoe31v8l_zns1f-azRQPhJ3DKIQJWUcQZ7Zix3M_zlaUMKtaB5W9zME7b

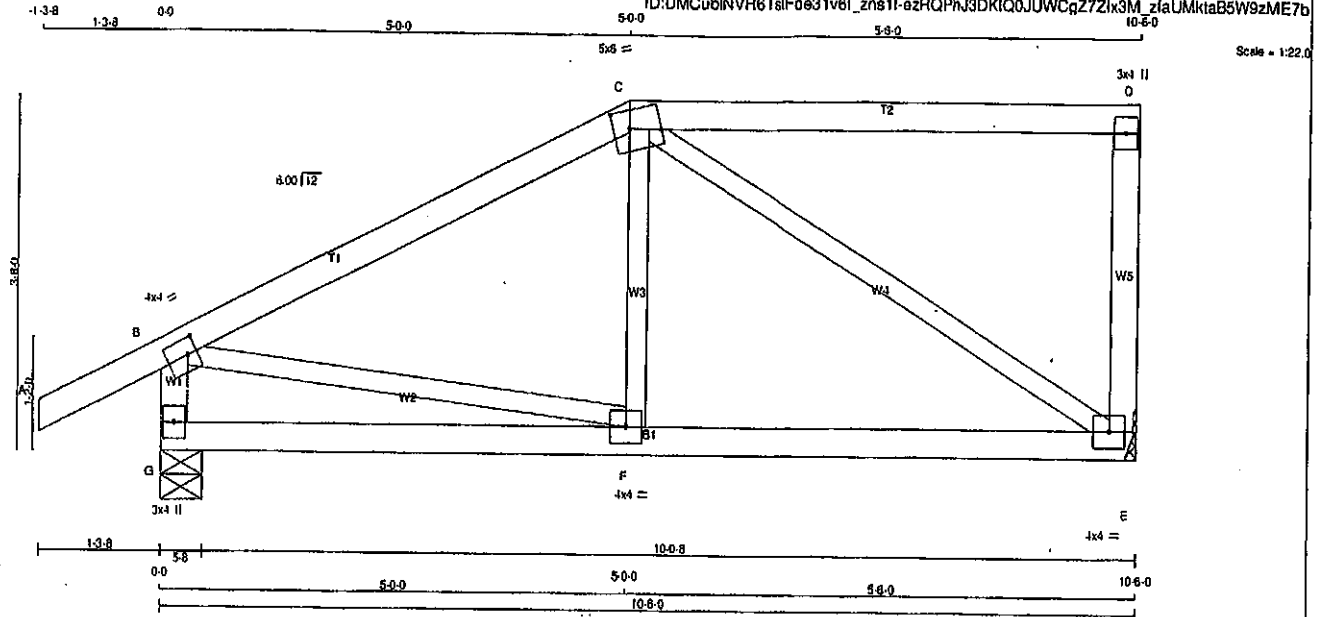

TOTAL WEIGHT = 42 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
E - D	2x4	DRY	No.2
G - B	2x4	DRY	No.2
G - E	2x4	DRY	No.2

ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	4.0	2.00 1.25
C	TTWW-m	MT20	5.0	6.0	2.25 2.00
D	TMV-p	MT20	3.0	4.0	
E	BMVW-1	MT20	4.0	4.0	
F	BMWW-1	MT20	4.0	4.0	
G	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT REQD BRG
E	579 0	579 0	MECHANICAL
G	703 0	703 0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX. MIN. COMPONENT REACTIONS				
E	409	289 0	0 0	0 0	0 0	141 0
G	495	338 0	0 0	0 0	0 0	157 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED CS (PL)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (PL)	
FR-TO				FR-TO			
A-B	0 28	-91.8	-91.8 0.12 (1)	10.00	F-C	0 106	0.04 (4)
B-C	-523 0	-91.8	-91.8 0.41 (1)	8.25	C-E	-549 0	0.37 (1)
C-D	0 0	-91.8	-91.8 0.47 (1)	10.00	B-F	0 474	0.11 (1)
E-D	-252 0	0.0	0.0 0.05 (1)	7.81			
G-B	-667 0	0.0	0.0 0.07 (1)	7.81			
G-F	0 0	-18.5	-18.5 0.14 (4)	10.00			
F-E	0 468	-18.5	-18.5 0.19 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6:00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.35")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.35")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSI: TC=0.47 1.00 (C-D:1), BC=0.19/1.00 (E-F:4), WB=0.37 1.00 (C-E:1), SS=0.20/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	616 354	1667 768

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (B) (INPUT = 0.90)
JSI METAL = 0.28 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007670

Version 9.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:20:10 2020 Page 1
ID:DMCubINVR6TstFoe31v8l zns11-bMYBqMKJxY8FdevJ5bbej0KcoeV2Tf1LugCb2zME7Z




JSI GRIP = 0.25 (A) (INPUT = 0.90)
JSI METAL = 0.07 (A) (INPUT = 1.00)

Structural component only
DWG# T-2007671

JOB NAME 408224	TRUSS NAME G50	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 3.310 S Oct 29 2019 MTK Industries, Inc. Tue Apr 28 10:19:51 2020 Page 1
ID:DMCubINVR6TsIFoe31v6I zns1I-eli7r18OD69qTihFid7MikFo7CC5I2EzRaiQezME7s

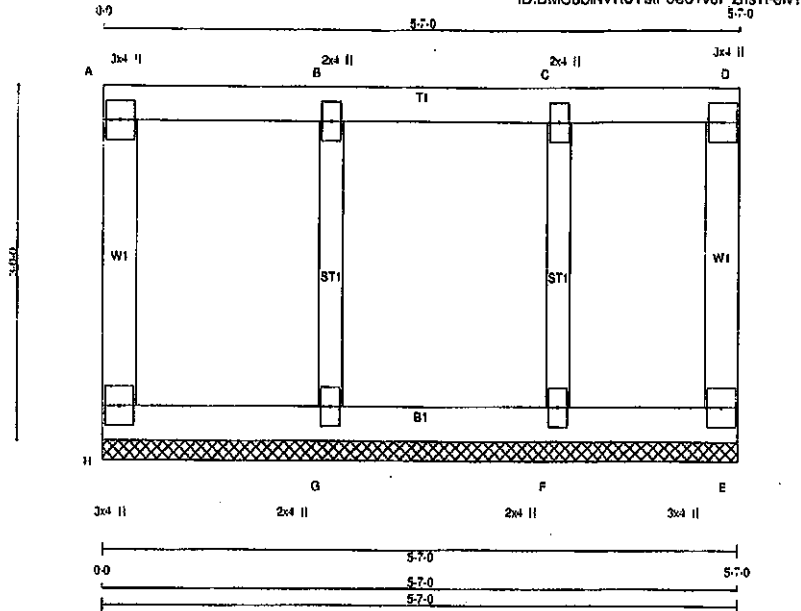

TOTAL WEIGHT = 22 lb (M/R)

LUMBER

N. L. G. A. RULES			
CHORDS	SIZE		LUMBER
H - A	2x4	DRY	No.2
A - D	2x4	DRY	No.2
E - D	2x4	DRY	No.2
H - E	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
ALL GABLE WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2'-0" O.C.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B	TMW+w	MT20	2.0	4.0		
C	TMV+w	MT20	2.0	4.0		
D	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		
F	BMW1+w	MT20	2.0	4.0		
G	BMW1+w	MT20	2.0	4.0		
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
H-A	-101 0	0.0 0.0 0.03 (1)	7.81	G-B	-248 0	0.08 (1)	
A-B	-8 0	-114.3 -114.3 0.08 (1)	10.00	F-C	-209 0	0.05 (1)	
B-C	-8 0	-114.3 -114.3 0.08 (1)	10.00				
C-D	-8 0	-114.3 -114.3 0.08 (1)	10.00				
E-D	-80 0	0.0 0.0 0.03 (1)	7.81				
H-G	0 8	-18.5 -18.5 0.02 (4)	10.00				
G-F	0 8	-18.5 -18.5 0.02 (4)	10.00				
F-E	0 8	-18.5 -18.5 0.02 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 15.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 48.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.0012

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.08/1.00 (A-B:1), BC=0.02/1.00 (G-H:1), WB=0.08/1.00 (B-G:1), SSI=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (G) INPUT = 0.90
JSI METAL= 0.07 (G) INPUT = 1.00



Structural component only
DWG# T-2007656

JOB NAME 408224	TRUSS NAME T51	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:20:11 2020 Page 1	

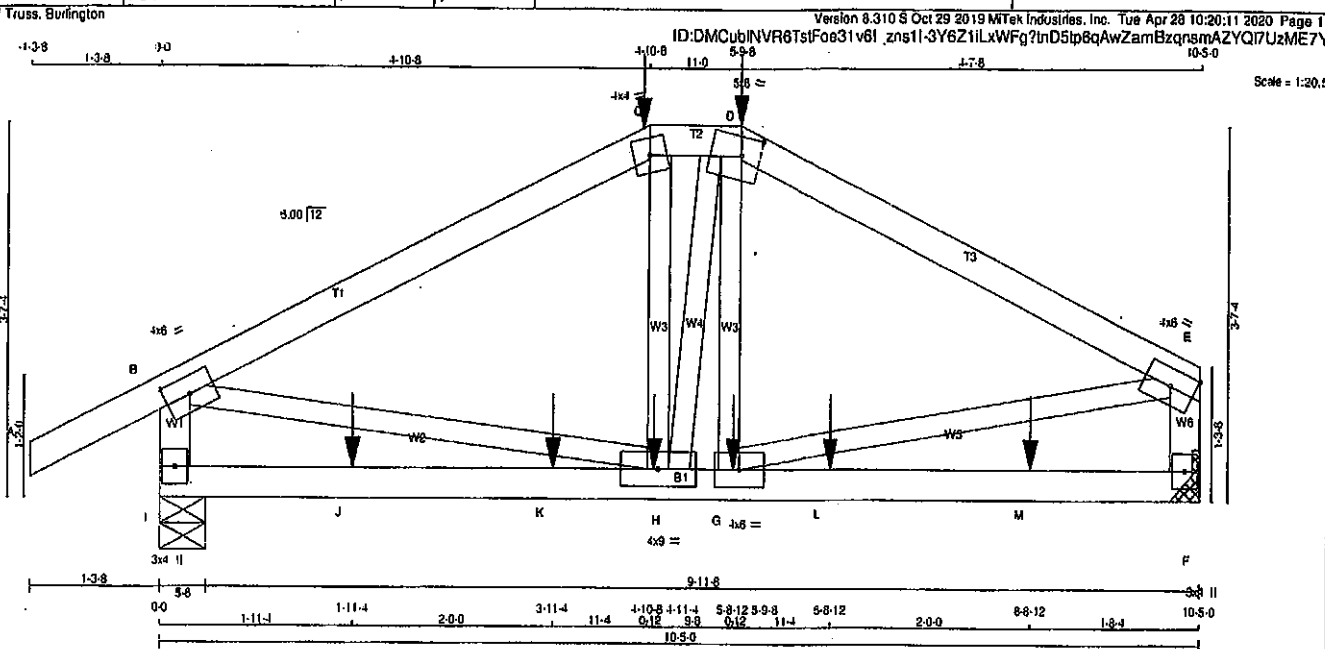


LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR
A - C	2x4	DRY	No.2
C - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - E	2x4	DRY	No.2
F - F	2x4	DRY	No.2
I - F	2x4	DRY	No.2
ALL WEBS			
EXCEPT	2x3	DRY	No.2
			SPF

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T52	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:20:12 2020 Page 1
ID:DMCubINVR6TstFoa31v6l_zns11-XlpxF2MaHZpsUxoIRWd388cEbM8WMqK9J(wzME7X

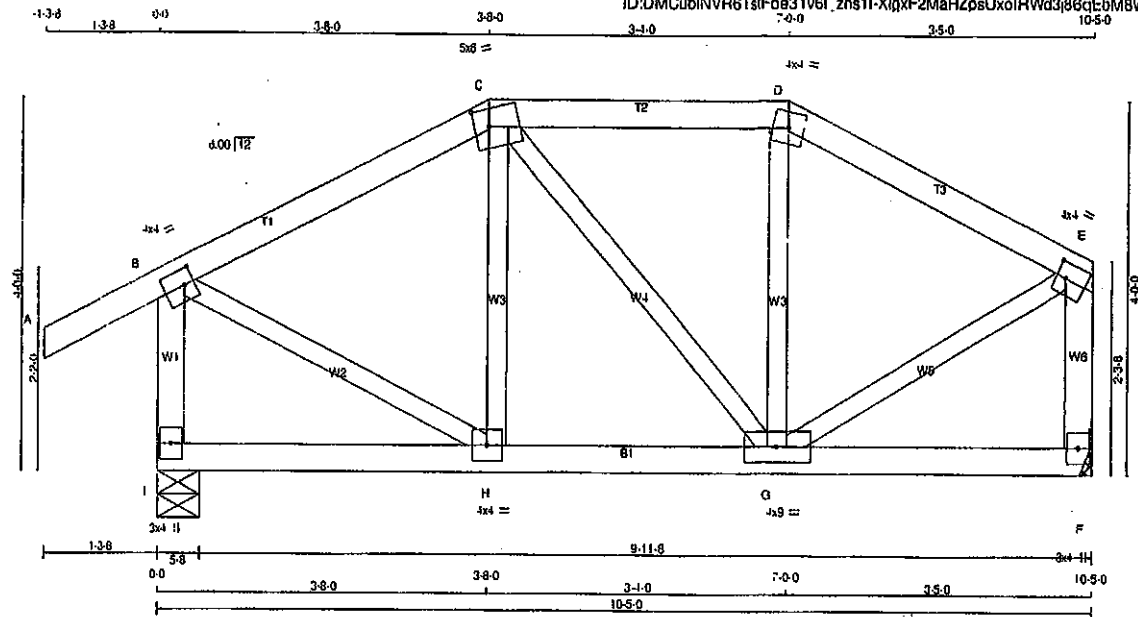

Scale = 1:22.8

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
E - F	2x4	DRY	No.2	SPF	
F - G	2x4	DRY	No.2	SPF	
G - H	2x4	DRY	No.2	SPF	
H - I	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMW-1	MT20	4.0	4.0	2.00	1.25
C	TTW-m	MT20	5.0	6.0	2.25	2.00
D	TTW-m	MT20	4.0	4.0		
E	TMW-1	MT20	4.0	4.0	2.00	1.25
F	BMV1-p	MT20	3.0	4.0		
G	BMWVW-1	MT20	4.0	9.0		
H	BMWVW-1	MT20	4.0	4.0		
I	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORIZ	UPLIFT
I	699	0	699	0
F	574	0	574	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	492	336 0	0 0	0 0	0 0	156 0	0 0
F	406	287 0	0 0	0 0	0 0	140 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED	FORCE	VERT. LOAD	LC1	MAX	UNBRAC	MEMB.	MAX. FACTORED	FORCE	MAX
			(LBS)	(PLF)	(LC)					(LBS)	(LC)
FR-TO								FR-TO			
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00	H-C	-116	14	0.03 (1)	
B-C	-423	0	-91.8	-91.8	0.16 (1)	8.25	C-G	-20	0	0.01 (1)	
C-D	-382	0	-91.8	-91.8	0.13 (1)	6.25	G-D	-128	8	0.03 (1)	
D-E	-409	0	-91.8	-91.8	0.14 (1)	8.25	B-H	0	422	0.09 (1)	
E-F	-669	0	0.0	0.0	0.08 (1)	7.81	G-E	0	419	0.09 (1)	
F-G	-546	0	0.0	0.0	0.07 (1)	7.81					
I-H	0	0	-18.5	-18.5	0.05 (4)	10.00					
H-G	0	375	-18.5	-18.5	0.09 (1)	10.00					
G-F	0	0	-18.5	-18.5	0.05 (4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.16/1.00 (B-C:1), BC=0.09/1.00 (G-H:1), WB=0.09/1.00 (B-H:1), SSI=0.12/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MT20	618	354
	1687	788
	1987	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.65 (B) INPUT = 0.90
JSI METAL= 0.21 (B) INPUT = 1.00

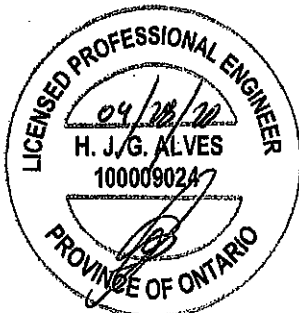

Structural component only
DWG# T-2007673

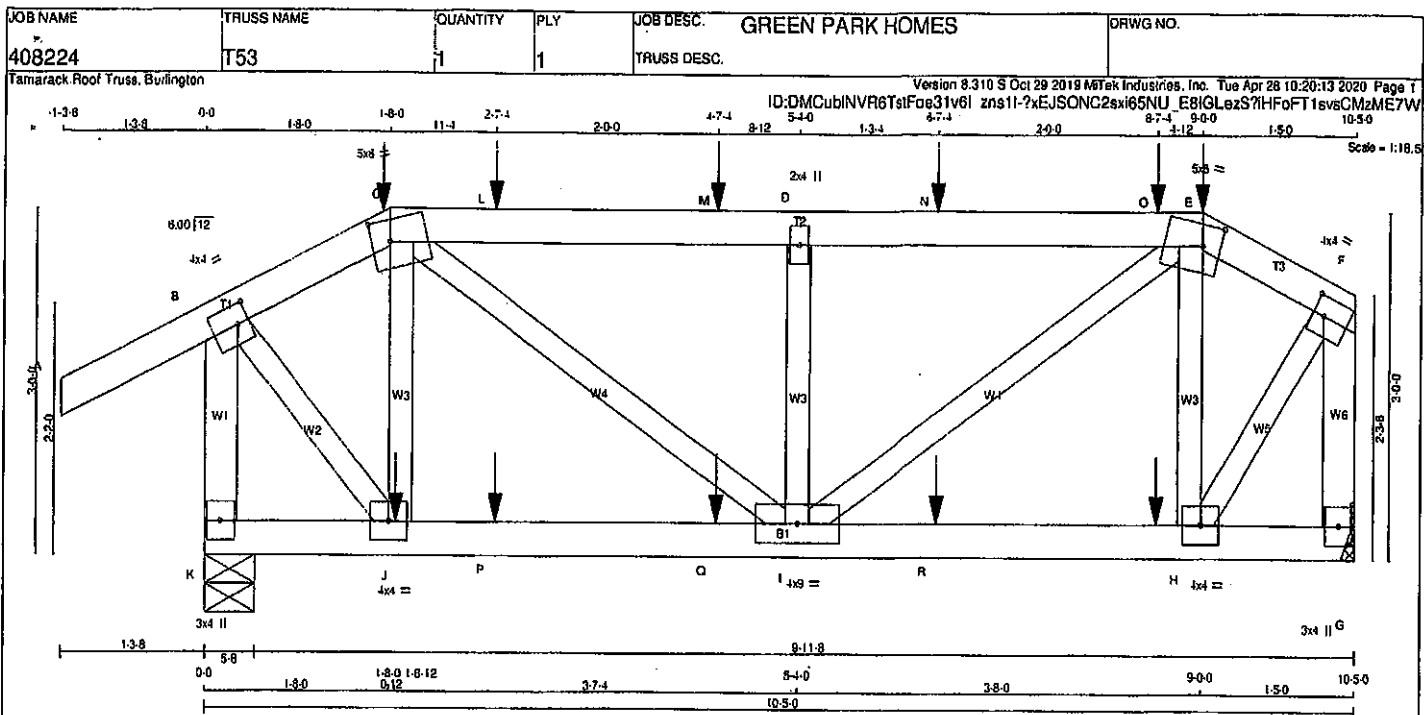

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
K - D	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
K - G	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (tab/e is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMWV-1	MT20	4.0	4.0	2.00	1.25
C TTWW-m	MT20	5.0	6.0	2.25	2.00
D TMW-w	MT20	2.0	4.0		
E TTWW-m	MT20	5.0	6.0	2.25	2.00
F TMWV-1	MT20	4.0	4.0	2.00	1.25
G BMV1-p	MT20	3.0	4.0		
H BMWW-1	MT20	4.0	4.0		
I BMWW-1	MT20	4.0	9.0		
J BMWW-1	MT20	4.0	4.0		
K BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
K	818 0	818 0	5-8	5-8
G	679 0	679 0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 1-8.

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	578	393 0	0 0	0 0	0 0	183 0	0 0
G	480	317 0	0 0	0 0	0 0	162 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 MAX. UNBRACED LENGTH (FT)	
FR-TO				FR-TO			
A-B	0 28	-91.8 -91.8 0.13 (1)	10.00	J-C	-307 0	0.06 (1)	
B-C	-427 0	-91.8 -91.8 0.13 (1)	8.25	C-I	0 438	0.11 (1)	
C-L	-702 0	-91.8 -91.8 0.26 (1)	8.25	I-D	-472 0	0.09 (1)	
L-M	-702 0	-91.8 -91.8 0.26 (1)	8.25	E-E	0 469	0.12 (1)	
M-D	-702 0	-91.8 -91.8 0.26 (1)	8.25	H-E	-373 0	0.07 (1)	
D-N	-702 0	-91.8 -91.8 0.26 (1)	8.25	B-J	0 523	0.13 (1)	
N-O	-702 0	-91.8 -91.8 0.26 (1)	8.25	H-F	0 558	0.14 (1)	
O-E	-702 0	-91.8 -91.8 0.26 (1)	8.25				
E-F	-379 0	-91.8 -91.8 0.04 (1)	8.25				
K-B	-812 0	0.0 0.0 0.10 (1)	7.81				
G-F	-677 0	0.0 0.0 0.09 (1)	7.81				
K-J	0 0	-18.5 -18.5 0.04 (4)	10.00				
J-P	0 349	-18.5 -18.5 0.09 (1)	10.00				
P-Q	0 349	-18.5 -18.5 0.09 (1)	10.00				
Q-I	0 349	-18.5 -18.5 0.09 (1)	10.00				
I-R	0 324	-18.5 -18.5 0.09 (1)	10.00				
R-H	0 324	-18.5 -18.5 0.09 (1)	10.00				
H-G	0 0	-18.5 -18.5 0.04 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	1-8-0	-53	-53	---	BACK	VERT	---	C1
E	9-0-0	-21	-21	---	FRONT	VERT	---	C1
H	8-7-4	-4	-4	---	BACK	VERT	---	C1
J	1-8-12	-4	-4	---	BACK	VERT	---	C1
L	2-7-4	-28	-28	---	BACK	VERT	---	C1
M	4-7-4	-25	-25	---	BACK	VERT	---	C1
N	6-7-4	-25	-25	---	BACK	VERT	---	C1
O	8-7-4	-53	-53	---	BACK	VERT	---	C1
P	2-7-4	-4	-4	---	BACK	VERT	---	C1
Q	4-7-4	-4	-4	---	BACK	VERT	---	C1
R	6-7-4	-4	-4	---	BACK	VERT	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

*** NON STANDARD GIRDER ***

ADDTL. USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.26/1.00 (O-E:1), BC=0.09/1.00 (I-J:1), WB=0.14/1.00 (F-H:1), SSI=0.21/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1697 768 1997 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.77 (F) INPUT = 0.99
JSI METAL = 0.22 (F) INPUT = 1.00



Structural component only
DWG# T-2007674

JOB NAME 408224	TRUSS NAME T54S	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Tue Apr 28 10:20:14 2020 Page 1 ID:DMCubINVR6TstFoe31v8l zns1I-T7ohgkQqpA3ZkEynYxpXoZB2uPsf_43dGWwCkzME7V 10-6-8 Scale = 1:16.5			

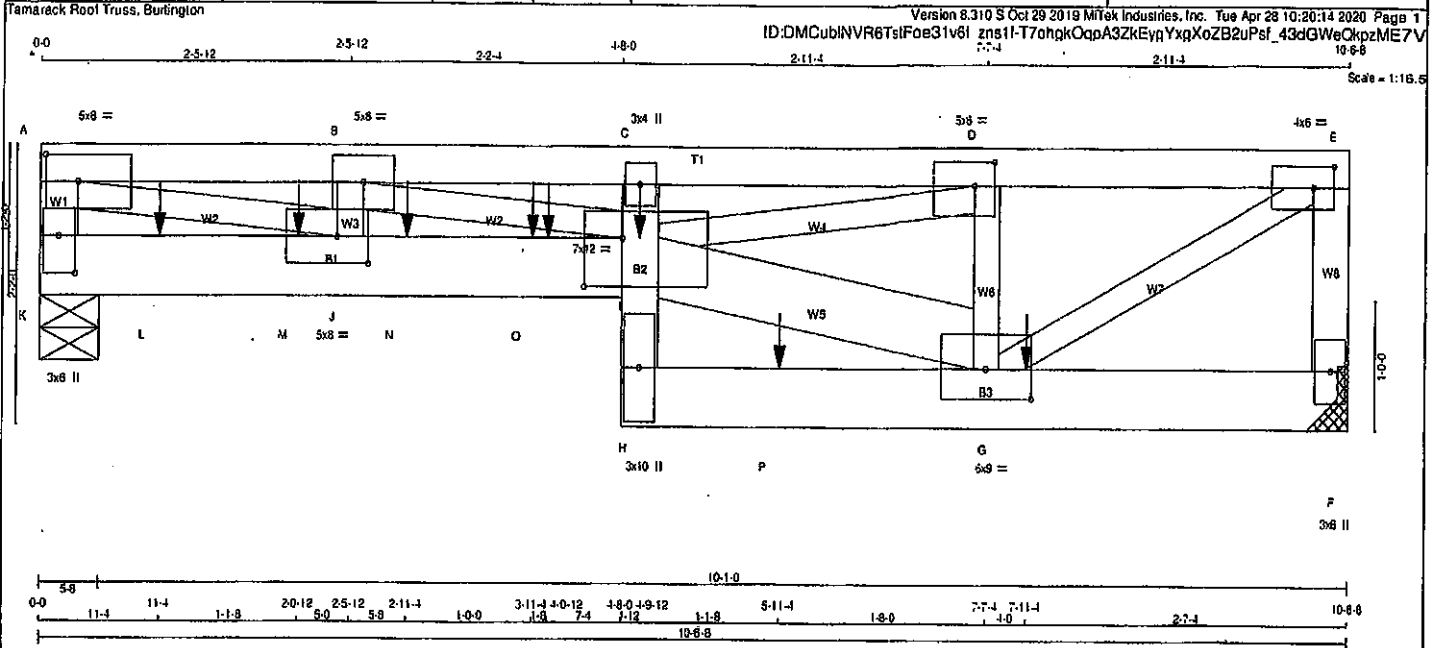

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. K - A 2x4 DRY No.2 SPF A - E 2x4 DRY No.2 SPF F - E 2x4 DRY No.2 SPF K - I 2x6 DRY No.2 SPF H - C 2x4 DRY No.2 SPF H - F 2x6 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT I - G 2x6 DRY No.2 SPF DRY: SEASONED LUMBER. DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS: CHORDS #ROWS SURFACE SPACING (IN) LOAD (PLF) TOP CHORDS : (0.122"x3") SPIRAL NAILS K-A 1 12 TOP A-E 1 12 TOP E-F 1 12 TOP BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS K-I 2 12 SIDE (61.0) H-F 2 12 SIDE (183.1) C-H 1 5 SIDE (89.0) WEBS : (0.122"x3") SPIRAL NAILS 2x3 1 8 2x6 2 6 NAILS TO BE DRIVEN FROM ONE SIDE ONLY. GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS. TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.		DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED MAXIMUM FACTORED INPUT REORD GROSS REACTION GROSS REACTION BRG BRG JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX K 2804 0 2804 0 0 5-8 5-8 F 2255 0 2255 0 0 MECHANICAL A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F MINIMUM BEARING LENGTH AT JOINT F = 4-0. UNFACTORED REACTIONS 1ST LOASE MAX. MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM. LIVE WIND DEAD SOIL K 1841 1212 0 0 0 0 0 628 0 0 0 F 1592 1081 0 0 0 0 0 531 0 0 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.36 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS FACTORED FACTORED WEBS FACTORED MEMB. FORCE VERT. LOAD LC1 MAX. MAX. MEMB. MAX. FORCE MAX. (LBS) (PLF) CSI (LC) UNBRAC LENGTH FR-TO (LBS) CSI (LC) FR-TO FROM TO K-A -2274 0 0.0 0.0 0.13 (1) 7.42 I-G 0 2388 0.19 (1) A-B -6694 0 -91.8 -91.8 0.22 (1) 3.63 I-D 0 5928 0.73 (1) B-C -10298 0 -91.8 -91.8 0.88 (1) 2.38 G-D -2148 0 0.17 (1) C-D -9247 0 -91.8 -91.8 0.81 (1) 2.62 G-E 0 4043 0.50 (1) D-E -3416 0 -91.8 -91.8 0.18 (1) 4.91 J-B -1577 0 0.12 (1) F-E -2242 0 0.0 0.0 0.13 (1) 7.46 A-J 0 7027 0.87 (1) B-I 0 3806 0.47 (1) K-L 0 0 -18.5 -18.5 0.21 (1) 10.00 L-M 0 0 -18.5 -18.5 0.21 (1) 10.00 M-J 0 0 -18.5 -18.5 0.21 (1) 10.00 J-N 0 6894 -18.5 -18.5 0.79 (1) 10.00 N-O 0 6894 -18.5 -18.5 0.79 (1) 10.00 O-I 0 6894 -18.5 -18.5 0.79 (1) 10.00 I-H 0 354 0.0 0.0 0.65 (1) 10.00 H-C 0 128 0.0 0.0 0.63 (1) 10.00 H-P 0 832 -18.5 -18.5 0.20 (1) 10.00 P-G 0 832 -18.5 -18.5 0.20 (1) 10.00 G-F 0 0 -18.5 -18.5 0.01 (4) 10.00 FACTORED CONCENTRATED LOADS (LBS) JT LOC. LC1 MAX. MAX. FACE DIR. TYPE HEEL CONN. I 7-11-4 -861 -681 --- BACK VERT TOTAL --- C1 G 4-9-12 -577 -577 --- FRONT VERT TOTAL --- C1 L 11-4 -72 -72 --- BACK VERT TOTAL --- C1 M 2-0-12 -352 -352 --- FRONT VERT TOTAL --- C1 N 2-11-4 -142 -142 --- BACK VERT TOTAL --- C1 O 3-11-4 -883 -883 --- BACK VERT TOTAL --- C1 P 4-0-12 -354 -354 --- FRONT VERT TOTAL --- C1 O 5-11-4 -556 -556 --- BACK VERT TOTAL --- C1 CONNECTION REQUIREMENTS 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.		DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 25.6 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF CBC 2018, OBC 2012, ABC 2019 - PART 9 OF OBC 2012 (2019 AMENDMENT) - CSA 086-09, CSA 086-14 - TPIC 2011, TPIC 2014 (55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL) = L/360 (0.35") CALCULATED VERT. DEFL.(LL) = L/862 (0.15") ALLOWABLE DEFL.(TL) = L/360 (0.35") CALCULATED VERT. DEFL.(TL) = L/469 (0.27") CSI: TC=0.66/1.00 (B-C:1), BC=0.79/1.00 (J-I:1), WB=0.87/1.00 (A-J:1), GSI=0.45/1.00 (C-I:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00 COMPANION LIVE LOAD FACTOR = 1.00 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP (DRY) SHEAR SECTION (PS) (PL) (PL) MAX MIN MAX MIN MAX MIN MT20 618 354 1687 788 1987 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.88 (E) (INPUT = 0.90) JSI METAL= 0.73 (D) (INPUT = 1.00)	
---	--	---	--	--	--



Structural component only
DWG# T-2007675 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T54S	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			


Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:20:14 2020 Page 2


ID:DMCubINVR8Ts1Foe31v6l zns1I-T7ohgkOapA3ZkEygYxoXoZB2uPsl 43dGWoCkpozME7V

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	5.0	8.0	2.50	3.00
B	TMVW-1	MT20	5.0	6.0		
C	TMV+p	MT20	3.0	4.0		
D	TMVW-1	MT20	5.0	6.0	2.25	2.00
E	TMVW-1	MT20	4.0	6.0	2.00	2.00
F	BMV1+p	MT20	3.0	8.0		
G	BMVW-1	MT20	6.0	9.0	2.75	4.50
H	BMV+p	MT20	3.0	10.0		
I	BMVW-1	MT20	7.0	12.0	4.50	3.75
J	BMVW-1	MT20	5.0	8.0	2.50	3.00
K	BMV1+p	MT20	3.0	6.0	3.50	1.50

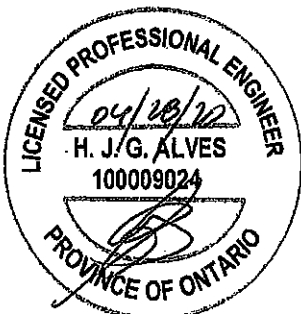

Structural component only
DWG# T-2007675

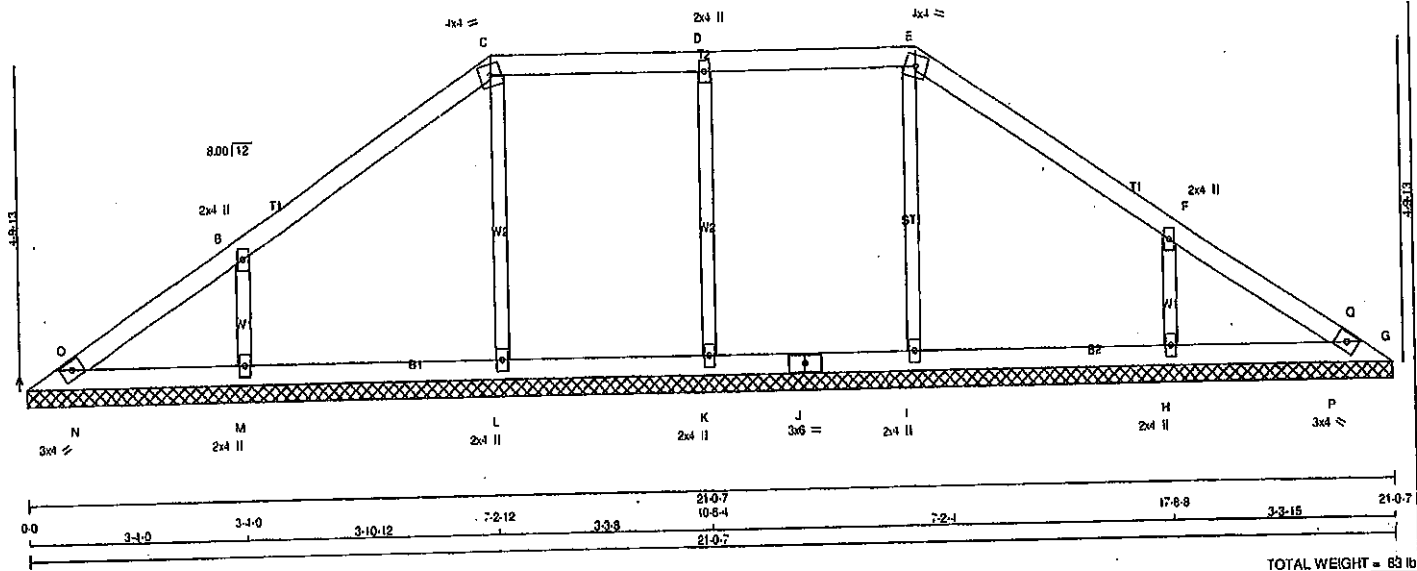

TOTAL WEIGHT = 83 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
A - J	2x4	DRY	No.2	SPF
J - G	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
A TBM1-h	MT20	3.0	4.0		
B, D, F					
B TWM+w	MT20	2.0	4.0		
C TTW-m	MT20	4.0	4.0		
E TTW-m	MT20	4.0	4.0		
G TBM1-h	MT20	3.0	4.0		
H, I, K, L, M					
H BMW1+w	MT20	2.0	4.0		
J BS-1	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
A	128	0	128	0	21-0-7	11-11220-7
G	128	0	128	0	21-0-7	11-11220-7
I	330	0	330	0	21-0-7	11-11220-7
L	330	0	330	0	21-0-7	11-11220-7
K	433	0	433	0	21-0-7	11-11220-7
H	485	0	485	0	21-0-7	11-11220-7
M	485	0	485	0	21-0-7	11-11220-7

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
		SNOW	LIVE			
A	90	61	0	0	29	0
G	90	61	0	0	29	0
I	235	143	0	0	93	0
L	235	143	0	0	93	0
K	304	212	0	0	92	0
H	342	228	0	0	114	0
M	342	228	0	0	114	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, G, I, L, K, H, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			FACTORED				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)		VERT. LOAD LG1 (PLF)	MAX CS1 (LC)	MAX UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)		
FR-TO			FROM	TO		FR-TO				
A-O	-23	2	-91.8	-91.8	0.04 (1)	6.25	E-E	-268	0	
O-B	0	33	-91.8	-91.8	0.21 (1)	10.00	L-C	-268	0	
B-C	-8	8	-91.8	-91.8	0.20 (1)	10.00	K-D	-377	0	
C-D	0	17	-91.8	-91.8	0.17 (1)	10.00	H-F	-393	0	
D-E	0	17	-91.8	-91.8	0.17 (1)	10.00	M-B	-393	0	
E-F	-8	8	-91.8	-91.8	0.20 (1)	10.00	N-O	-39	5	
F-G	0	33	-91.8	-91.8	0.21 (1)	10.00	P-Q	-39	5	
O-G	-23	2	-91.8	-91.8	0.04 (1)	6.25				
A-N	-9	0	-18.5	-18.5	0.05 (1)	10.00				
N-M	-7	7	-18.5	-18.5	0.06 (4)	10.00				
M-L	-11	0	-18.5	-18.5	0.06 (4)	6.25				
L-K	-17	0	-18.5	-18.5	0.05 (4)	6.25				
K-J	-17	0	-18.5	-18.5	0.05 (4)	6.25				
J-I	-17	0	-18.5	-18.5	0.06 (4)	6.25				
I-H	-11	0	-18.5	-18.5	0.06 (4)	6.25				
H-P	-7	7	-18.5	-18.5	0.06 (4)	10.00				
P-G	-9	0	-18.5	-18.5	0.05 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCG 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPGC 2011, TPGC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.21 (B-O:1), BC=0.08 (L-M:4), WB=0.13 (D-K:1), SSI=0.15 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES


PLATE GRIP (DRY)	SHEAR (PLI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.61 (C) INPUT = 0.90
JSI METAL= 0.20 (F) INPUT = 1.00



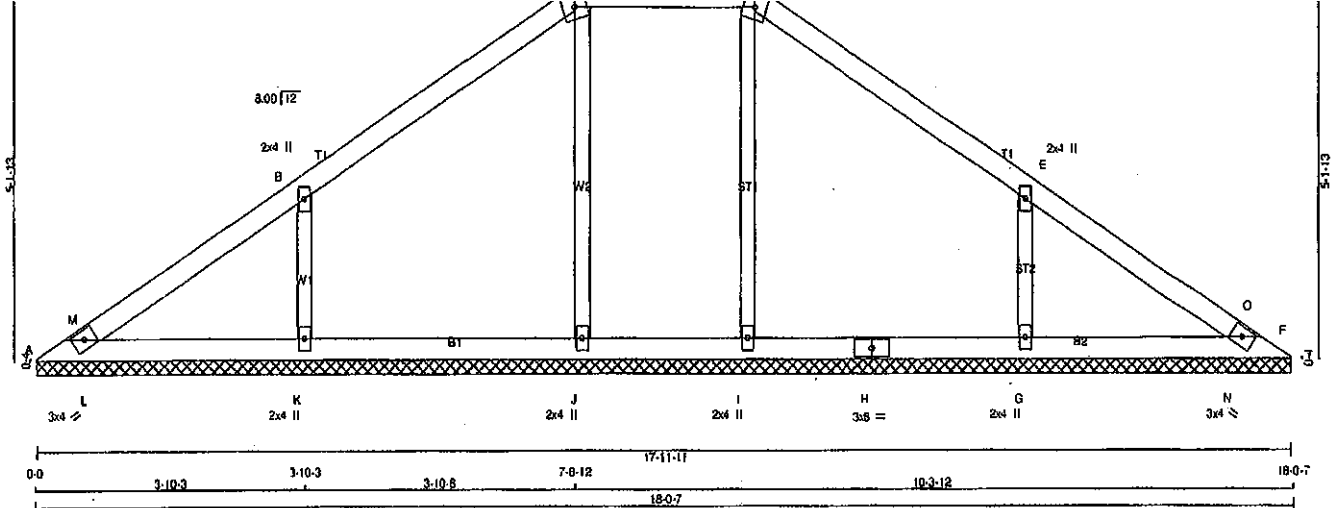

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
A - H	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (tablets in inches)	W	LEN	Y	X
JT TYPE	PLATES			
A - TBMI-h	MT20	3.0	4.0	
B - TMW-w	MT20	2.0	4.0	
C - TTW-m	MT20	4.0	4.0	
D - TTW-m	MT20	4.0	4.0	
E - TMW-w	MT20	2.0	4.0	
F - TBMI-h	MT20	3.0	4.0	
G, I, J, K				
G - BMW1-w	MT20	2.0	4.0	
H - BS-1	MT20	3.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
A	136	0	136	0
F	135	0	135	0
I	344	0	344	0
G	513	0	513	0
J	342	0	342	0
K	513	0	513	0

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
A	96	65	0	0	0	30	0
F	95	65	0	0	0	30	0
I	244	155	0	0	0	89	0
G	362	240	0	0	0	122	0
J	242	154	0	0	0	89	0
K	362	240	0	0	0	122	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, F, I, G, J, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED CSI (LBS)	UNBRACED LENGTH (FT)	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LBS)
FR-TO						FR-TO			
A-M	0	20	-91.8	-91.8	0.04 (1)	10.00	I-D	-292	0
M-B	0	71	-91.8	-91.8	0.22 (1)	10.00	G-E	-408	0
B-C	0	33	-91.8	-91.8	0.22 (1)	10.00	J-C	-291	0
C-D	0	52	-91.8	-91.8	0.11 (1)	10.00	K-B	-408	0
D-E	0	33	-91.8	-91.8	0.22 (1)	10.00	L-M	-71	4
E-O	0	71	-91.8	-91.8	0.22 (1)	10.00	N-O	-69	5
O-F	0	19	-91.8	-91.8	0.04 (1)	10.00			
A-L	-43	0	-18.5	-18.5	0.07 (1)	6.25			
L-K	-30	0	-18.5	-18.5	0.07 (1)	6.25			
K-J	-45	0	-18.5	-18.5	0.07 (4)	6.25			
J-I	-52	0	-18.5	-18.5	0.04 (4)	6.25			
I-H	-45	0	-18.5	-18.5	0.07 (4)	6.25			
H-G	-45	0	-18.5	-18.5	0.07 (4)	6.25			
G-N	-30	0	-18.5	-18.5	0.07 (1)	6.25			
N-F	-43	0	-18.5	-18.5	0.07 (1)	6.25			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.22(1.00(E-O:1)), BC=0.07(1.00(K-L:1)), WB=0.11(1.00(D-E:1)), SSI=0.14(1.00(D-E:1))

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 616 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.61 (C) (INPUT = 0.90)
JSI METAL=0.21 (E) (INPUT = 1.00)

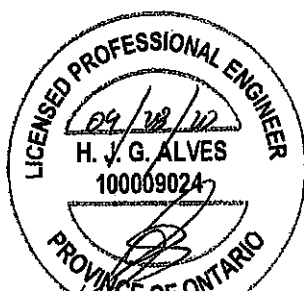

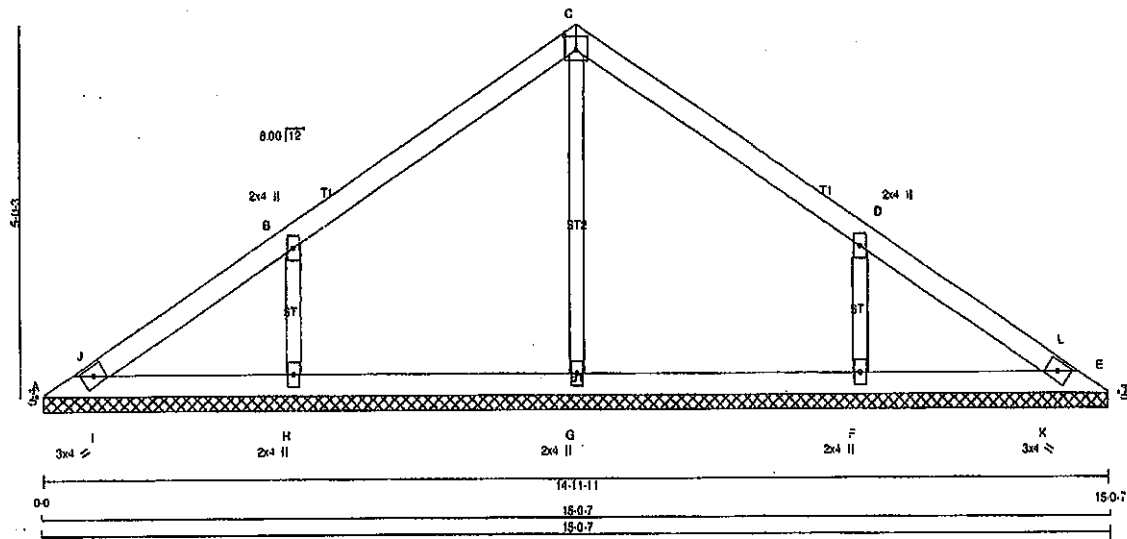

TOTAL WEIGHT = 43 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
A - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
SPF			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TBM1-h	MT20	3.0	4.0		
B	TBM1-w	MT20	2.0	4.0		
C	TTW-p	MT20	4.0	4.0	2.25	2.00
D	TBM1-w	MT20	2.0	4.0		
E	TBM1-h	MT20	3.0	4.0		
F, G, H						
F	BMW1-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
A	134	0	134	0	0	14-11-11	14-11-11	
E	134	0	134	0	0	14-11-11	14-11-11	
G	381	0	381	0	0	14-11-11	14-11-11	
H	501	0	501	0	0	14-11-11	14-11-11	
F	501	0	501	0	0	14-11-11	14-11-11	

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX. MIN. COMPONENT REACTIONS						
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
A	95	65	0	0	0	30	0	0
E	95	65	0	0	0	30	0	0
G	272	162	0	0	0	110	0	0
H	353	237	0	0	0	118	0	0
F	353	237	0	0	0	118	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, G, H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: 14)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM TO		FR-TO			
A-J	-20 4	-91.8 -91.8	0.04 (1)	6.25	G-C	-316 0	0.11 (1)
J-B	0 38	-91.8 -91.8	0.22 (1)	10.00	H-B	-405 0	0.08 (1)
B-C	-5 12	-91.8 -91.8	0.21 (1)	10.00	F-D	-405 0	0.08 (1)
C-D	-5 12	-91.8 -91.8	0.21 (1)	10.00	I-J	-46 8	0.00 (1)
D-L	0 38	-91.8 -91.8	0.22 (1)	10.00	K-L	-46 6	0.00 (1)
L-E	-20 4	-91.8 -91.8	0.04 (1)	6.25			
A-I	-13 0	-18.5 -18.5	0.06 (1)	6.25			
I-H	-10 3	-18.5 -18.5	0.06 (4)	6.25			
H-G	-13 0	-18.5 -18.5	0.06 (4)	6.25			
G-F	-13 0	-18.5 -18.5	0.06 (4)	6.25			
F-K	-10 3	-18.5 -18.5	0.06 (4)	6.25			
K-E	-13 0	-18.5 -18.5	0.06 (1)	6.25			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9. NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.9 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.22/1.00 (B-J:1), BC=0.06/1.00 (G-H:4), WB=0.11/1.00 (C-G:1), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES


PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	616 354	1667 768 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.26 (D) (INPUT = 0.90)
JSI METAL = 0.21 (D) (INPUT = 1.00)

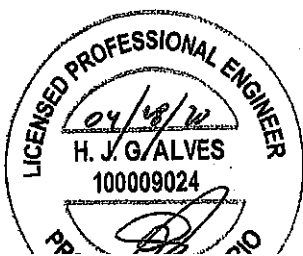

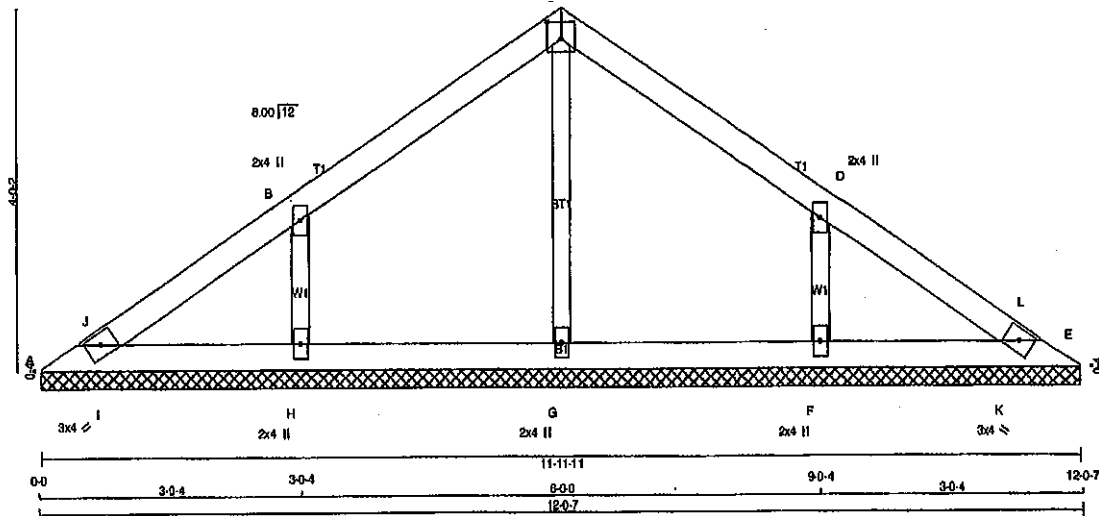

TOTAL WEIGHT = 34.8 kN

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER DESCR.
A - C 2x4 DRY No.2 SPF
C - E 2x4 DRY No.2 SPF
A - E 2x4 DRY No.2 SPF
ALL WEBS 2x3 DRY No.2 SPF
DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	RECORD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
A	117	0	117	0	11-11-11	11-11-11
E	117	0	117	0	11-11-11	11-11-11
G	290	0	290	0	11-11-11	11-11-11
F	398	0	398	0	11-11-11	11-11-11
H	398	0	398	0	11-11-11	11-11-11

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.13/1.00 (B-J:1), BC=0.05/1.00 (A-I:1), WB=0.08/1.00 (C-G:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.22 (D) (INPUT = 0.80)
JSI METAL= 0.16 (B) (INPUT = 1.00)

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TBM1-h	MT20	3.0	4.0		
B	TBM1-w	MT20	2.0	4.0		
C	TTW-p	MT20	4.0	4.0	2.25	2.00
D	TBM1-w	MT20	2.0	4.0		
E	TBM1-h	MT20	3.0	4.0		
F	BMW1-w	MT20	2.0	4.0		

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
A	83	58/0	0/0	0/0	0/0	26/0	0/0
E	83	58/0	0/0	0/0	0/0	26/0	0/0
G	207	125/0	0/0	0/0	0/0	82/0	0/0
F	281	188/0	0/0	0/0	0/0	93/0	0/0
H	281	188/0	0/0	0/0	0/0	93/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, G, F, H

BRACING


TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.


ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LG1 (PLF)	MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)		
FR-TO		FROM TO			FR-TO				
A-J	-8/5	-91.8	-91.8	0.03 (1)	10.00	G-C -248/0	0.06 (1)		
J-B	0/38	-91.8	-91.8	0.13 (1)	10.00	F-D -314/0	0.05 (1)		
B-C	0/12	-91.8	-91.8	0.13 (1)	10.00	H-B -314/0	0.05 (1)		
C-D	0/12	-91.8	-91.8	0.13 (1)	10.00	I-J -47/4	0.00 (1)		
D-L	0/36	-91.8	-91.8	0.13 (1)	10.00	K-L -47/4	0.00 (1)		
L-E	-8/5	-91.8	-91.8	0.03 (1)	10.00				
A-I	-13/0	-18.5	-18.5	0.05 (1)	6.25				
I-H	-10/0	-18.5	-18.5	0.05 (1)	10.00				
H-G	-20/0	-18.5	-18.5	0.04 (4)	6.25				
G-F	-20/0	-18.5	-18.5	0.04 (4)	6.25				
F-K	-10/0	-18.5	-18.5	0.05 (1)	10.00				
K-E	-13/0	-18.5	-18.5	0.05 (1)	6.25				

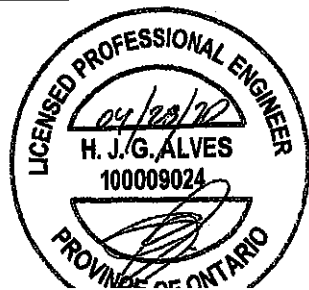

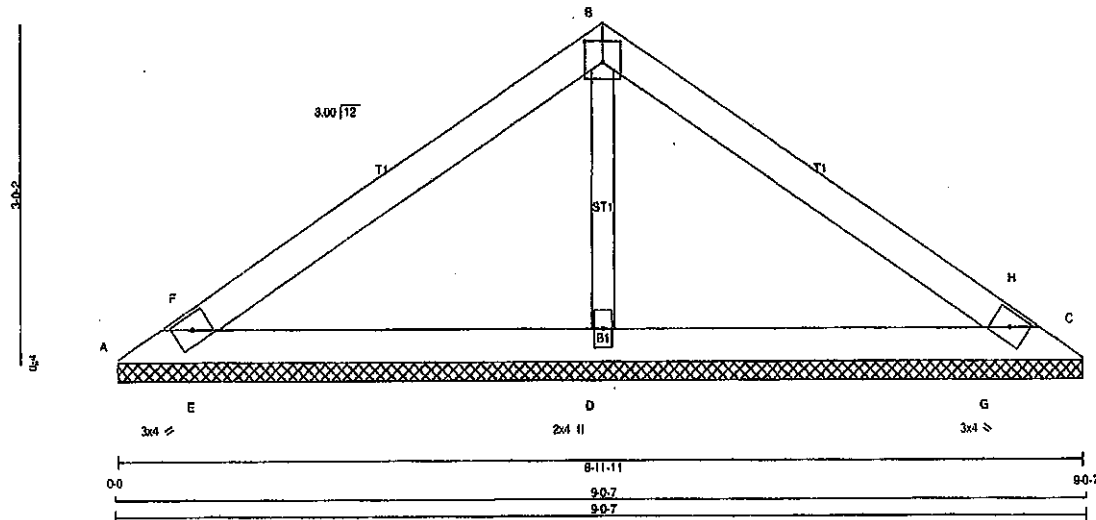

TOTAL WEIGHT = 23 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
A - C	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TBM1-h	MT20	3.0	4.0	
B	TTW-p	MT20	4.0	4.0	2.25 2.00
C	TBM1-h	MT20	3.0	4.0	
D	BMW1+w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		DOWN		DOWN		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
A	49	0	49	0	0	8-11-11	8-11-11		
C	49	0	49	0	0	8-11-11	8-11-11		
D	893	0	893	0	0	8-11-11	8-11-11		

UNFACTORED REACTIONS

1ST CASE		MAX/MIN COMPONENT REACTIONS		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL	DEAD	SOIL
A	34	22:0	0:0	0:0	0:0	12:0	0:0		
C	34	22:0	0:0	0:0	0:0	12:0	0:0		
D	831	415:0	0:0	0:0	0:0	216:0	0:0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WIND		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. (PLF)	MAX. (LBS)	MEMB.	FORCE (LBS)	MAX. (LBS)
FR-TO					FR-TO		
A-F	0 347	-91.8	-91.8 0.12 (1)	10.00	D-B	-898 0	0.12 (1)
F-B	0 341	-91.8	-91.8 0.23 (1)	10.00	E-F	-225 0	0.00 (1)
B-H	0 341	-91.8	-91.8 0.23 (1)	10.00	G-H	-225 0	0.00 (1)
H-C	0 347	-91.8	-91.8 0.12 (1)	10.00			
A-E	-321 0	-18.5	-18.5 0.18 (1)	6.25			
E-D	-290 0	-18.5	-18.5 0.17 (1)	6.25			
D-G	-290 0	-18.5	-18.5 0.17 (1)	6.25			
G-C	-321 0	-18.5	-18.5 0.16 (1)	6.25			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL =	6.0	PSF
BOT CH.	LL = 0.0	PSF
DL =	7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.23/1.00 (B-F:1), BC=0.17/1.00 (D-E:1), WB=0.12/1.00 (B-D:1), SS=0.12/1.00 (A-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
(PLI)	(PLI)	(PLI)	(PLI)
MT20	818	354	1667
	788	1987	1636

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.59 (B) (INPUT = 0.90)
JSI METAL = 0.20 (B) (INPUT = 1.00)

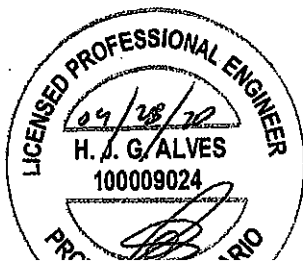

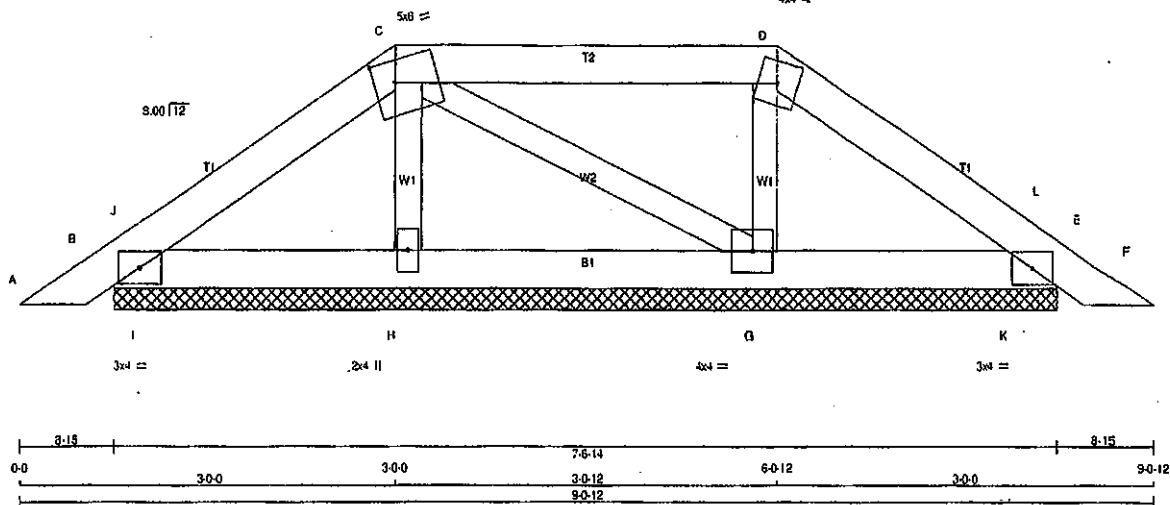

TOTAL WEIGHT = 2 X 25 = 50 lb (M)

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
B - E	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMB1-I	MT20	3.0	4.0		
C TTWW-m	MT20	5.0	6.0	2.00	2.00
D TTW-m	MT20	4.0	4.0		
E TMB1-I	MT20	3.0	4.0		
G BMWW1-I	MT20	4.0	4.0		
H BMW1+W	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD
	VERT	HORZ	DOWN	HORZ
B	221	0	221	0
E	209	0	209	0
H	248	0	248	0
G	280	0	280	0

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	154	113	0	0.0	0.0	0.0	41	0.0
E	146	108	0	0.0	0.0	0.0	39	0.0
H	178	109	0	0.0	0.0	0.0	67	0.0
G	198	127	0	0.0	0.0	0.0	71	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0 15	-91.8	-91.8 0.03 (1)	10.00	H-C	-178 0	0.03 (1)
B-J	-63 0	-91.8	-91.8 0.01 (1)	6.25	C-G	-21 0	0.00 (1)
J-C	-75 0	-91.8	-91.8 0.05 (1)	6.25	G-D	-198 0	0.03 (1)
C-D	-30 0	-91.8	-91.8 0.15 (1)	6.25	I-J	-121 0	0.00 (1)
D-L	-54 0	-91.8	-91.8 0.05 (1)	6.25	K-L	-123 0	0.00 (1)
L-E	-41 0	-91.8	-91.8 0.01 (1)	6.25			
E-F	0 15	-91.8	-91.8 0.03 (1)	10.00			
B-I	0 80	-18.5	-18.5 0.05 (1)	10.00			
I-H	0 80	-18.5	-18.5 0.05 (1)	10.00			
H-G	0 48	-18.5	-18.5 0.03 (1)	10.00			
G-K	0 43	-18.5	-18.5 0.05 (1)	10.00			
K-E	0 43	-18.5	-18.5 0.05 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP - CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS1 TC=0.15 (C-D:1), BC=0.08 (B-E:1), WB=0.03 (D-G:1), SS1=0.11 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES


PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) INPUT = 0.90
JSI METAL= 0.04 (B) INPUT = 1.00



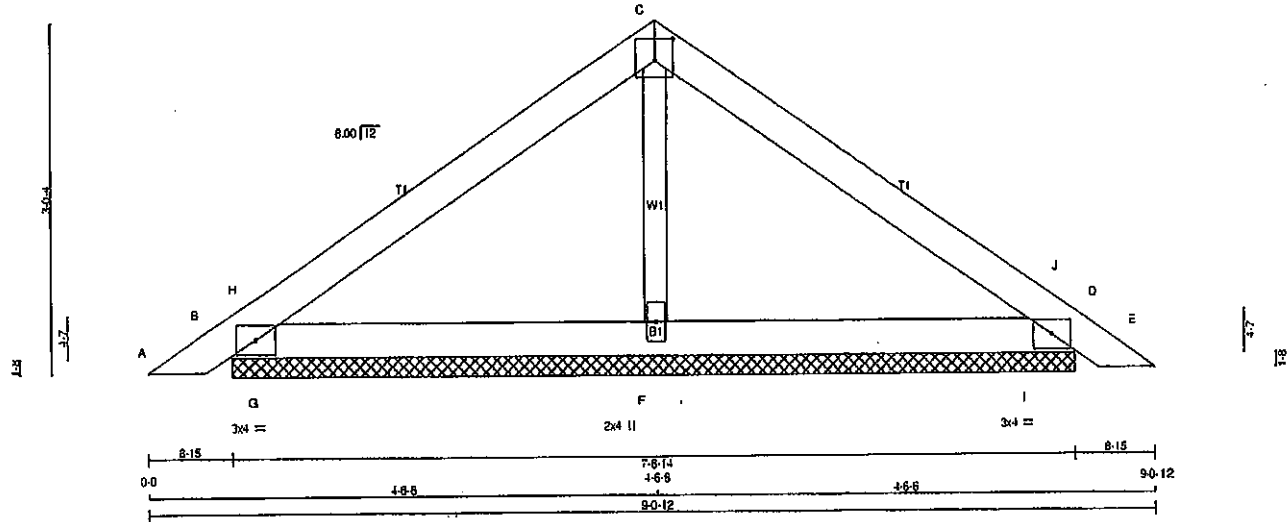

TOTAL WEIGHT = 2 X 23 = 46 lb

LUMBER

N. L. G. A. RULES

CHORDS SIZE

A - C 2x4 DRY

C - E 2x4 DRY

B - D 2x4 DRY

ALL WEBS 2x3 DRY

DRY: SEASONED LUMBER.

LUMBER

No.2

No.2

No.2

No.2

DESCR.

SPF

SPF

SPF

SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ UPLIFT
B	318	0	318	0
D	318	0	318	0
F	320	0	320	0

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	223	158	0	0	0	0	83	0
D	223	158	0	0	0	0	83	0
F	229	137	0	0	0	0	92	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	MAX. FACTORED FORCE (LBS)
FR-TO				FR-TO			
A-B	0 15	-91.8	-91.8 0.03 (1)	10.00	F-C	-148 0	0.03 (1)
B-H	-31 0	-91.8	-91.8 0.07 (1)	8.25	G-H	-349 0	0.09 (1)
H-C	-135 0	-91.8	-91.8 0.16 (1)	8.25	I-J	-349 0	0.09 (1)
C-J	-135 0	-91.8	-91.8 0.16 (1)	8.25			
J-D	-31 0	-91.8	-91.8 0.07 (1)	8.25			
D-E	0 15	-91.8	-91.8 0.03 (1)	10.00			
B-G	0 105	-18.5	-18.5 0.15 (1)	10.00			
G-F	0 105	-18.5	-18.5 0.15 (1)	10.00			
F-I	0 105	-18.5	-18.5 0.15 (1)	10.00			
F-D	0 105	-18.5	-18.5 0.15 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL	LOAD =	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.16/1.00 (C-J:1), BC=0.15/1.00 (F-I:1), WB=0.03/1.00 (C-F:1), SS=0.26/1.00 (D-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES


PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.28 (D) (INPUT = 0.90)
JSI METAL= 0.07 (D) (INPUT = 1.00)



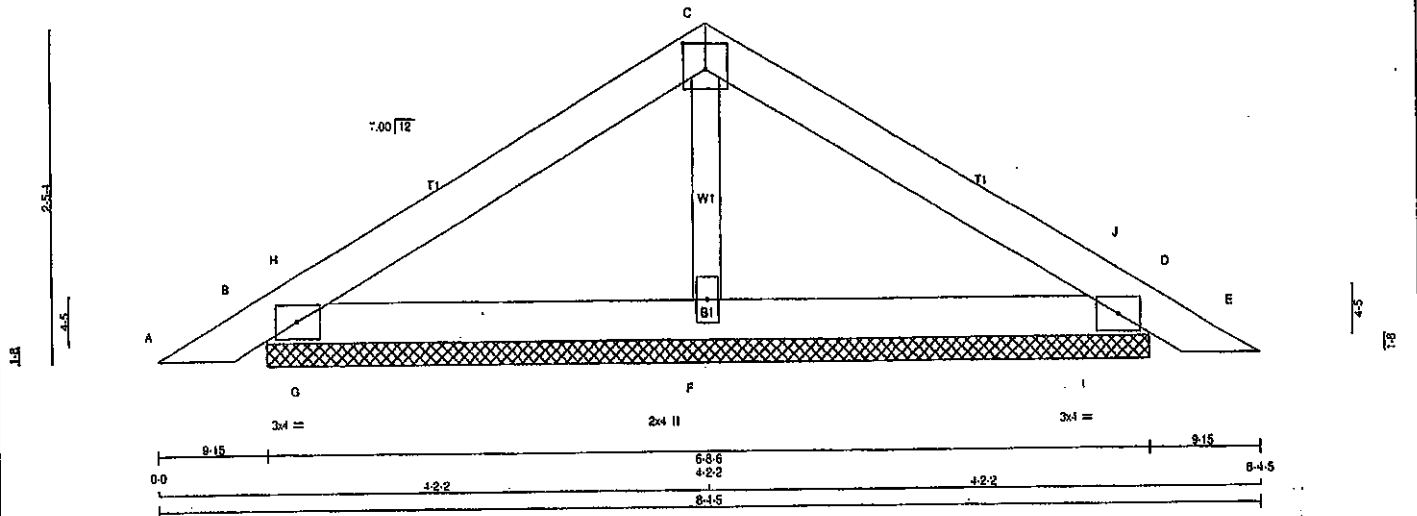

TOTAL WEIGHT = 4 X 20 = 80 lb

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
B - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMB1-I	MT20	3.0	4.0	
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TMB1-I	MT20	3.0	4.0	
F	BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
B	281	0	281	0	0	6-8-6	6-8-6	6-8-6	6-8-6
D	281	0	281	0	0	6-8-6	6-8-6	6-8-6	6-8-6
F	314	0	314	0	0	6-8-6	6-8-6	6-8-6	6-8-6

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	197	141 0	0 0	0 0	0 0	55 0	0 0	0 0
D	197	141 0	0 0	0 0	0 0	55 0	0 0	0 0
F	224	137 0	0 0	0 0	0 0	87 0	0 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FACTORED	VERT. LOAD LC1	MAX. FACTORED	MEMB.	MAX. FACTORED	VERT. LOAD LC1	MAX. FACTORED
	FORCE (LBS)	(PLF)	CS1 (LG)		FORCE (LBS)	(PLF)	CS1 (LG)
FR-TO		FROM TO		FR-TO		FROM TO	
A-B	0 10	-91.8 -91.8 0.04 (1)	10.00	F-C	-150 0	0.02 (1)	
B-H	-44 0	-91.8 -91.8 0.05 (1)	8.25	G-H	-250 0	0.00 (1)	
H-C	-88 0	-91.8 -91.8 0.12 (1)	6.25	I-J	-250 0	0.00 (1)	
C-J	-99 0	-91.8 -91.8 0.12 (1)	6.25				
J-D	-44 0	-91.8 -91.8 0.05 (1)	8.25				
D-E	0 10	-91.8 -91.8 0.04 (1)	10.00				
B-G	0 81	-18.5 -18.5 0.12 (1)	10.00				
G-F	0 81	-18.5 -18.5 0.12 (1)	10.00				
F-I	0 81	-18.5 -18.5 0.12 (1)	10.00				
I-D	0 81	-18.5 -18.5 0.12 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL	8.0	PSF
BOT CH.	LL = 0.0	PSF
DL	7.4	PSF
TOTAL LOAD	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS1: TC=0.12/1.00 (C-H-1), BC=0.12/1.00 (B-G-1), WB=0.02/1.00 (C-F-1), SS=0.18/1.00 (D-I-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618 354 1667 788 1867 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.24 (D) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)

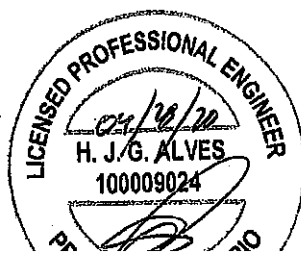

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	PB21	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:03:57 2020 Page 1
ID:DMCubINVR6tstFoe31v6l zns11-aAGLcfZ u zB05wpFeQIXDDeZbFaPRpb0UDxxzMEMm

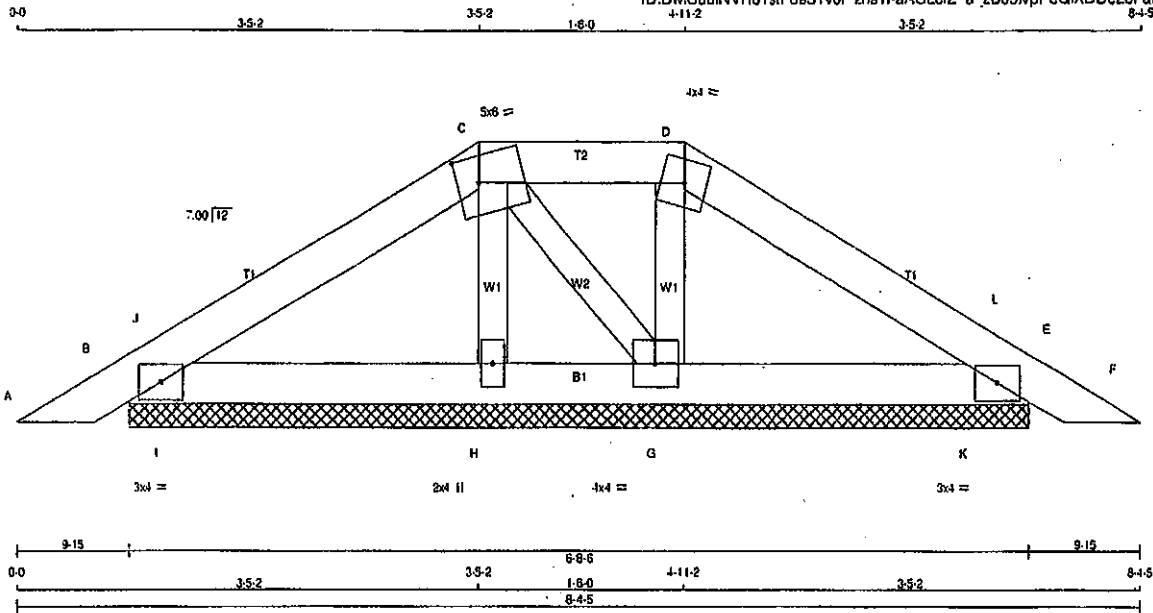

Scale = 1:15.2

TOTAL WEIGHT = 22 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
B - E	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY:	SEASONED LUMBER.				

PLATES (tablets in inches)	W	LEN	Y	X
JT TYPE PLATES	3.0	4.0		
B TMB1-J	MT20	3.0	4.0	
C TTWW-m	MT20	5.0	8.0	2.25 2.00
D TTWW-m	MT20	4.0	4.0	
E TMB1-J	MT20	3.0	4.0	
G BMW1+1	MT20	4.0	4.0	
H BMW1+w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
B	241	0	241	0	8-8-8	8-8-8
E	228	0	228	0	8-8-8	8-8-8
H	170	0	170	0	8-8-8	8-8-8
G	238	0	238	0	8-8-8	8-8-8

UNFACTORED REACTIONS

JT	COMBINED	1ST CASE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
		SNOW	LIVE	PERM	LIVE			
B	189	121.0	0.0	0.0	0.0	0.0	48.0	0.0
E	180	114.0	0.0	0.0	0.0	0.0	48.0	0.0
H	122	74.0	0.0	0.0	0.0	0.0	48.0	0.0
G	188	111.0	0.0	0.0	0.0	0.0	57.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 16	-91.8 -91.8 0.04 (1)	10.00	H-C	-107 0	0.02 (1)	
B-J	-59 0	-91.8 -91.8 0.01 (1)	6.25	C-G	-38 0	0.01 (1)	
J-C	-71 0	-91.8 -91.8 0.07 (1)	6.25	G-D	-147 0	0.02 (1)	
C-D	-28 0	-91.8 -91.8 0.04 (1)	6.25	F-J	-139 0	0.00 (1)	
D-L	-46 0	-91.8 -91.8 0.07 (1)	6.25	K-L	-141 0	0.00 (1)	
L-E	-33 0	-91.8 -91.8 0.01 (1)	6.25				
E-F	0 16	-91.8 -91.8 0.04 (1)	10.00				
B-I	0 59	-18.5 -18.5 0.07 (1)	10.00				
I-H	0 59	-18.5 -18.5 0.07 (1)	10.00				
H-G	0 52	-18.5 -18.5 0.04 (1)	10.00				
G-K	0 38	-18.5 -18.5 0.07 (1)	10.00				
K-E	0 38	-18.5 -18.5 0.07 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CD

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012: ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.07:1.00 (D-L:1), BC=0.07:1.00 (B-I:1), WB=0.02:1.00 (D-G:1), SSI=0.11:1.00 (E-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.19 (B) (INPUT = 0.90)
JSI METAL= 0.05 (D) (INPUT = 1.00)




Structural component only
DWG# T-2007628

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	PB22	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:03:58 2020 Page 1
ID:DMCubINVR6TsfFos31v8I_zns11-2Mqjq7acH52eFK5Nz9IEkmO2zyGJsPzqpDmTNzMEMI

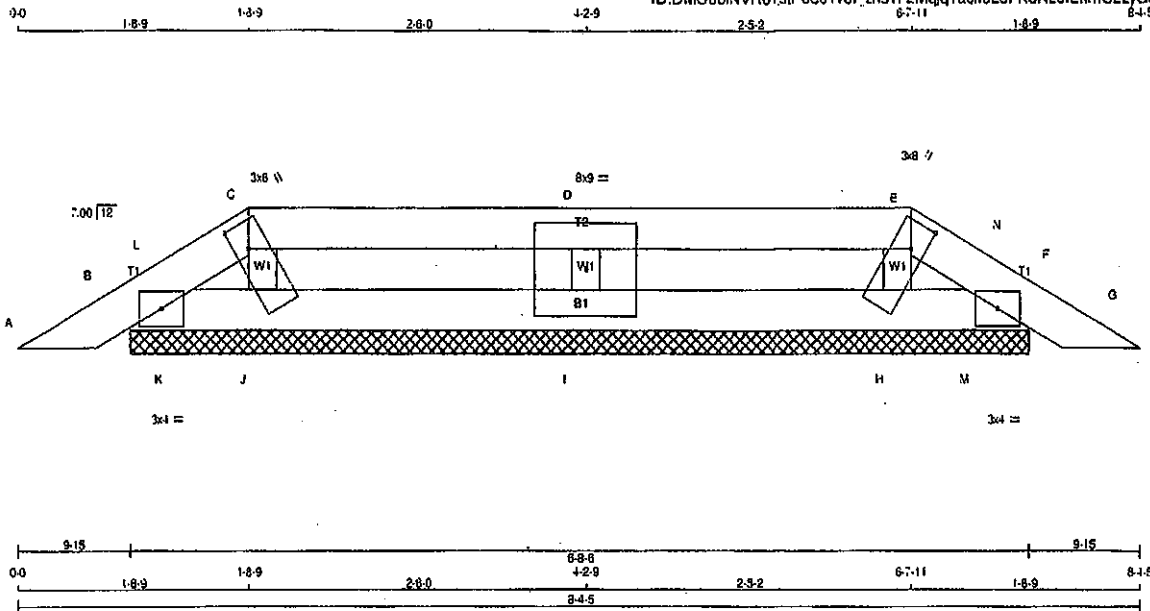

Scale = 1:15.2

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER	DESCR.	
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
E - G	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	
ALL WEBS 2x3 DRY			No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (tablets in inches)	W	LEN	Y	X
JT TYPE	PLATES			
B	TMB1-I	MT20	3.0	4.0
C, D, E, H, I, J				
C	TTBW1*+h	MT20	3.0	8.0
D	TMBMW1-I	MT20	8.0	9.0
E	TTBW1*+h	MT20	3.0	8.0
H	TMB1-I	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	UPLIFT
B	151	0	151	0
F	152	0	152	0
J	125	0	125	0
H	120	0	120	0
I	330	0	330	0

UNFACTORED REACTIONS

1ST LOASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	105	83 0	0 0	0 0	0 0	21 0	0 0
F	105	83 0	0 0	0 0	0 0	22 0	0 0
J	90	49.0	0 0	0 0	0 0	41 0	0 0
H	86	47 0	0 0	0 0	0 0	39 0	0 0
I	232	158 0	0 0	0 0	0 0	74 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, F, J, H, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED CS1 (LC)	UNBRAC LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)
FR-TO						FR-TO			
A-B	0	16	-91.8	-91.8	0.04 (1)	10.00	J-C	-95	0
B-L	-53	0	-91.8	-91.8	0.04 (1)	6.25	H-E	-92	0
L-C	-22	0	-91.8	-91.8	0.01 (1)	6.25	I-D	-282	0
C-D	0	3	-91.8	-91.8	0.09 (1)	10.00	K-L	-1	12
D-E	0	3	-91.8	-91.8	0.09 (1)	10.00	M-N	0	13
E-N	-21	0	-91.8	-91.8	0.01 (1)	6.25			
N-F	-52	0	-91.8	-91.8	0.04 (1)	6.25			
F-G	0	18	-91.8	-91.8	0.04 (1)	10.00			
B-K	0	14	-18.5	-18.5	0.01 (1)	10.00			
K-J	0	14	-18.5	-18.5	0.02 (4)	10.00			
J-I	-3	0	-18.5	-18.5	0.02 (4)	10.00			
I-H	-3	0	-18.5	-18.5	0.02 (4)	10.00			
H-M	0	14	-18.5	-18.5	0.01 (4)	10.00			
M-F	0	14	-18.5	-18.5	0.01 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CS1: TC=0.08/1.00 (D-E:1), BC=0.02/1.00 (H-J:4), WB=0.04/1.00 (D-K:1), SG=0.11/1.00 (C-D:1)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PS) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.13 (C) INPUT = 0.90
JSI METAL = 0.04 (C) INPUT = 1.00




Structural component only
DWG# T-2007629

JOB NAME 408223	TRUSS NAME P20	QUANTITY 17	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	----------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:03:55 2020 Page 1
ID:DMCubINVR6TstF0e31v6l zn811-en8bC XkMNjUnocWiqbyd68sgmus6Uhw8i76i2zMEMo

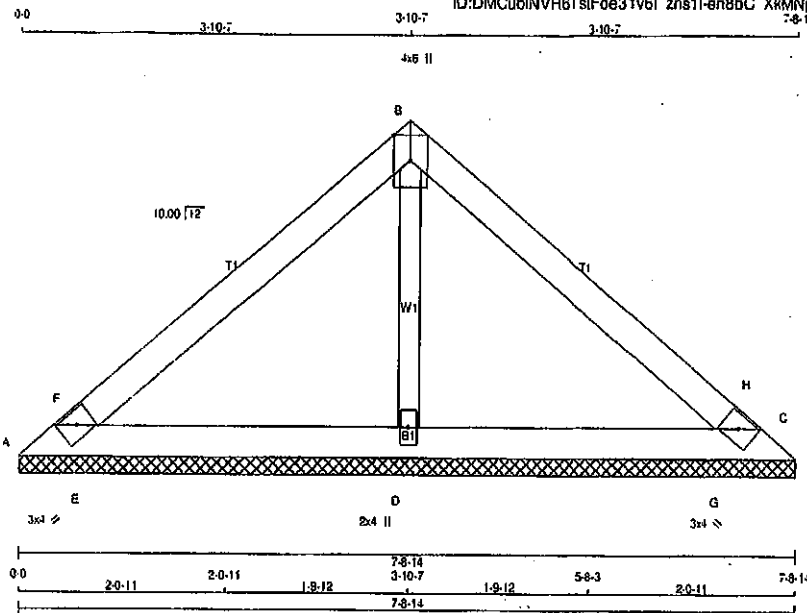

TOTAL WEIGHT = 17 X 21 = 357 lb

LUMBER	N.L.G.A. RULES	CHORDS - SIZE	LUMBER
A - B	2x4 DRY	No.2	
B - C	2x4 DRY	No.2	
A - C	2x4 DRY	No.2	
ALL WEBS	2x3 DRY	No.2	
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)	JT TYPE	PLATES	W	LEN	Y	X
A - TBM1-h	MT20	3.0	4.0			
B - TTW+p	MT20	4.0	6.0	Edge		
C - TBM1-h	MT20	3.0	4.0			
D - BMW1+w	MT20	2.0	4.0			

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
JT	GROSS REACTION	GROSS REACTION	BRG	BRG
	VERT	DOWN	UPLIFT	IN-SX
A	60	0	0	7-8-14
C	60	0	0	7-8-14
D	733	0	0	7-8-14

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	43	28	0	0	0	0	14	0
C	42	28	0	0	0	0	14	0
D	518	339	0	0	0	0	179	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS A, C, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED	FACTORED	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD	LC1 MAX	MEMB.	FORCE	MAX	MAX
FR-TO	(LBS)	(PLF)	CSI (LC)	FR-TO	(LBS)	CSI (LC)	CSI (LC)
A-F	0 227	-91.8	-91.8 0.09 (1)	D-B	-558 0	0.10 (1)	
F-B	0 219	-91.8	-91.8 0.17 (1)	E-F	-199 0	0.00 (1)	
B-H	0 219	-91.8	-91.8 0.17 (1)	G-H	-199 0	0.00 (1)	
H-C	0 228	-91.8	-91.8 0.09 (1)				
A-E	-207 0	-18.5	-18.5 0.13 (1)				
E-D	-174 0	-18.5	-18.5 0.13 (1)				
D-G	-174 0	-18.5	-18.5 0.13 (1)				
G-C	-207 0	-18.5	-18.5 0.13 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TG=0.17 1.00 (B-F:1), BC=0.13 1.00 (D-E:1), WB=0.10 1.00 (B-D:1), SS=0.11 1.00 (C-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

NAIL VALUES		SHEAR		SECTION		
PLATE	GRP(DRY)	(PSI)	(PLI)	(PLI)	(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1887	788	1987	1858

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.29 (D) INPUT = 0.90
JSI METAL = 0.12 (D) INPUT = 1.00



Structural component only
DWG# T-2007626

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	PG20	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

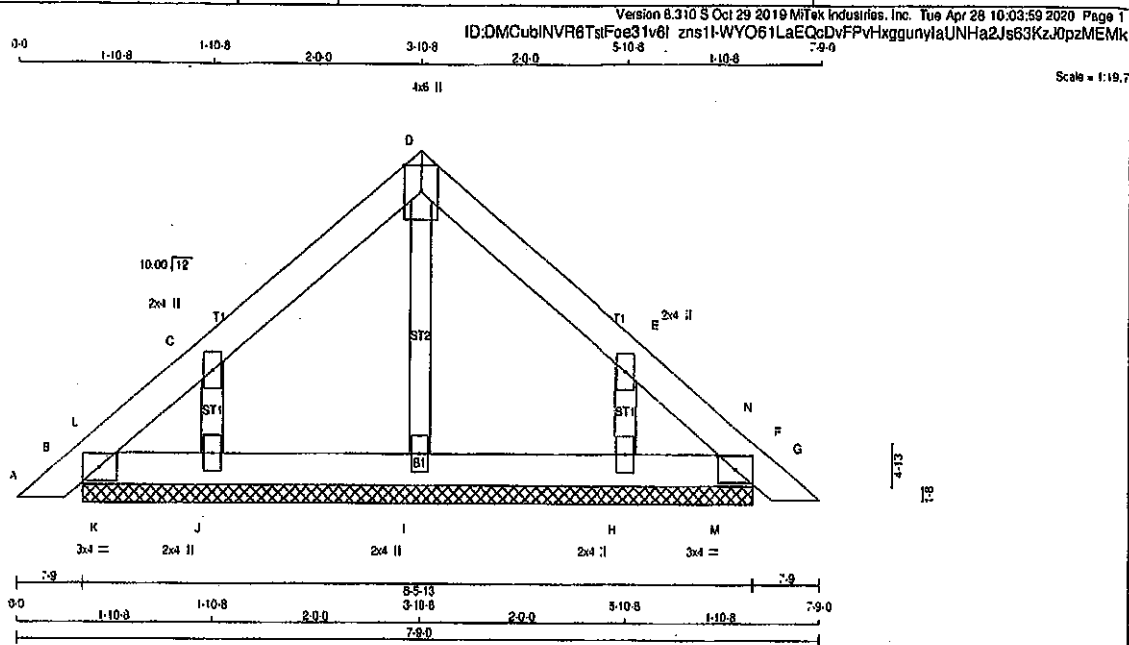

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4 DRY	No.2	SPF		
D - G	2x4 DRY	No.2	SPF		
B - F	2x4 DRY	No.2	SPF		
ALL WEBS	2x3 DRY	No.2	SPF		
ALL GABLE WEBS	2x3 DRY	No.2	SPF		
DRY: SEASONED LUMBER.					

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
8	TMB1-I	MT20	3.0	4.0	1.50	2.00
C	TMW+w	MT20	2.0	4.0		
D	TTW+p	MT20	4.0	6.0	Edge	
E	TMW+w	MT20	2.0	4.0		
F	TMB1-I	MT20	3.0	4.0	1.50	2.00
H, I, J						
H	BMW1+w	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (LBS)	FACTORED (PLF)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED (LBS)	FACTORED (LBS)
FR-TO				FR-TO			
A-B	0 14	-91.8	-91.8 0.02 (1)	10.00	I-D	-111 0	0.02 (1)
B-L	-71 0	-91.8	-91.8 0.00 (1)	8.25	J-C	-185 0	0.03 (1)
L-C	-30 0	-91.8	-91.8 0.05 (1)	8.25	H-E	-185 0	0.03 (1)
C-D	-47 0	-91.8	-91.8 0.05 (1)	8.25	K-L	0 9	0.00 (1)
D-E	-47 0	-91.8	-91.8 0.05 (1)	8.25	M-N	0 9	0.00 (1)
E-N	-30 0	-91.8	-91.8 0.05 (1)	8.25			
N-F	-71 0	-91.8	-91.8 0.00 (1)	8.25			
F-G	0 14	-91.8	-91.8 0.02 (1)	10.00			
S-K	0 44	-18.5	-18.5 0.01 (1)	10.00			
K-J	0 44	-18.5	-18.5 0.01 (4)	10.00			
J-I	0 27	-18.5	-18.5 0.02 (4)	10.00			
I-H	0 27	-18.5	-18.5 0.02 (4)	10.00			
H-M	0 44	-18.5	-18.5 0.01 (4)	10.00			
M-F	0 44	-18.5	-18.5 0.01 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.8 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 38.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

165% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.05/1.00 (C-D:1), BC=0.02/1.00 (H-I:4), WS=0.03/1.00 (C-J:1), SSI=0.07/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1667
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.14 (E) INPUT = 0.90
JSI METAL = 0.10 (C) INPUT = 1.00



Structural component only
DWG# T-2007630

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	J1	21	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 8 Oct 2019 Mitek Industries, Inc. Tue Apr 28 09:00:01 2020 Page 1					
ID:DMCubINVR6TsFoe31v61_zns1f-uBTBW78oHNgUpbV15dpsEbLZQFMuoV7BWCFEHhZMFI					
Scale = 1:22.9					

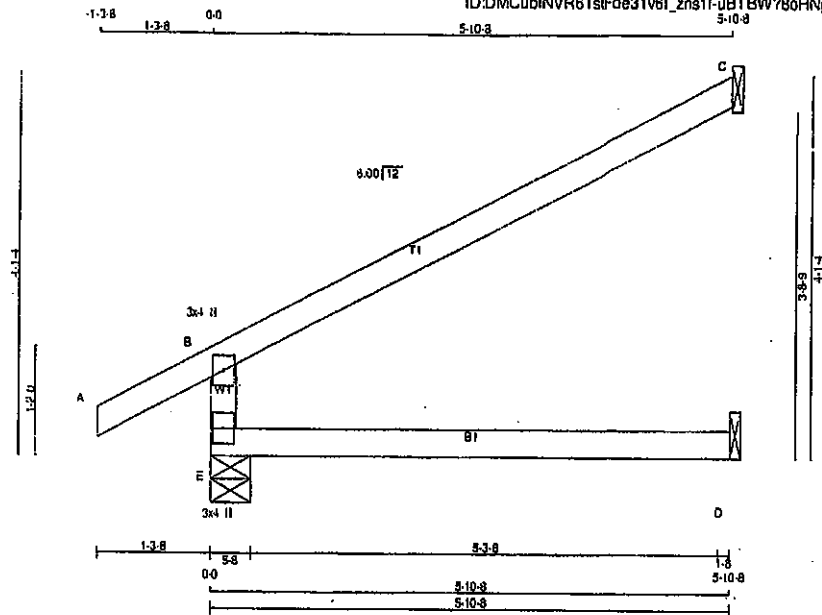

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2		
A - C	2x4	DRY	No.2		
E - D	2x4	DRY	No.2		

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
E	525	0	525	0
C	202	0	202	0
D	45	0	50	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED						
E	369	257	0	0	0	111	0
C	139	113	0	0	0	28	0
D	38	0	0	0	0	35	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS (LC)	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)
FR-TO		FROM TO			FR-TO		
E-B	-161	0	0.0	0.0	0.13 (4)	7.81	
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00	
B-C	-30	0	-91.8	-91.8	0.54 (1)	6.25	
E-D	0	0	-18.5	-18.5	0.13 (4)	10.00	

TOTAL WEIGHT = 21 X 17 = 353 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 (N.C.)

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.207)
CALCULATED VERT. DEFL.(LL) = L/999 (0.007)
ALLOWABLE DEFL.(TL) = L/360 (0.207)
CALCULATED VERT. DEFL.(TL) = L/999 (0.037)

CS: TC=0.54 (1.00) (B-C:1), BC=0.13 (1.00) (D-E:4), WB=0.00 (1.00) (max), SS=0.24 (1.00) (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (RY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.19 (E), INPUT = 0.90
JSI METAL = 0.13 (B), INPUT = 1.00




Structural component only
DWG# T-2007598

JOB NAME 408222	TRUSS NAME J2S	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:00:01 2020 Page 1

ID:DMCubINVR6TstFoa31v6I_zna11-uBTBW78oHNgUpbV15dpsEblHhFOVoUrBWCfEHzMFII

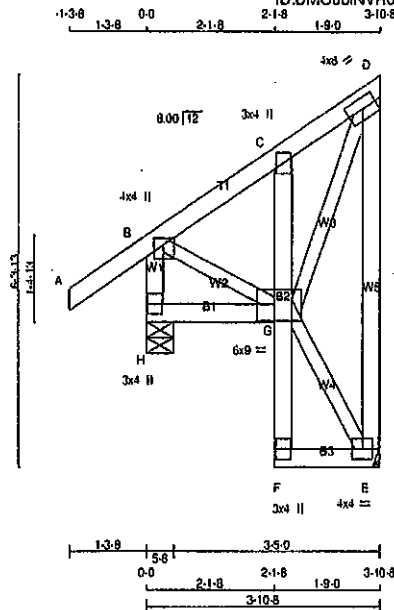

Scale = 1/4" = 1'-0"

TOTAL WEIGHT = 4 X 31 = 125 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
H - B	2x4	DRY	No. 2	SPF		
A - D	2x4	DRY	No. 2	SPF		
H - G	2x4	DRY	No. 2	SPF		
F - C	2x4	DRY	No. 2	SPF		
F - E	2x4	DRY	No. 2	SPF		
ALL WEBS	2x3	DRY	No. 2	SPF		
EXCEPT						
E - D	2x4	DRY	No. 2	SPF		

DRY: SEASONED LUMBER.

PLATES (table in inches)	TYPE	PLATES	W	LEN	Y	X
JT	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TMVW+p	MT20	3.0	4.0		
C	TMVW+p	MT20	4.0	8.0	2.00	2.75
D	TMVW-1	MT20	4.0	4.0		
E	BMVW-1	MT20	3.0	4.0		
F	BMVW-1	MT20	6.0	9.0	3.25	3.50
G	BMVW-1	MT20	3.0	4.0		
H	BMVW-1	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
H	332	0	332	0
E	208	0	208	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED
H	232
E	145

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD	MEMB.	FORCE
	(LBS)	(PLF)		(LBS)
FR-TO		FROM TO	FR-TO	
H-B	-311 0	0.0	0.0	0.03 (1)
A-B	0 35	-91.8	-91.8	0.14 (5)
B-C	-96 0	-91.8	-91.8	0.05 (1)
C-D	-105 0	-91.8	-91.8	0.05 (1)
H-G	0 0	-18.5	-18.5	0.03 (4)
F-G	0 15	0.0	0.0	0.01 (1)
G-C	-202 0	0.0	0.0	0.01 (1)
F-E	0 4	-18.5	-18.5	0.01 (4)

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL, OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = 1.380 (0.19")
CALCULATED VERT. DEFL. (LL) = 1.999 (0.00")
ALLOWABLE DEFL. (TL) = 1.380 (0.19")
CALCULATED VERT. DEFL. (TL) = 1.999 (0.00")

CSI: TC=0.14-1.00 (A-B:5), BC=0.03-1.00 (G-H:4), WB=0.08-1.00 (D-E:1), SSI=0.09-1.00 (A-B:5)

OOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.22 (B) INPUT = 0.90
JSI METAL= 0.07 (C) INPUT = 1.00

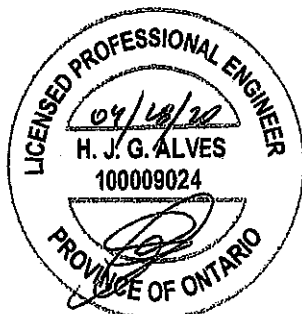


Structural component only
DWG# T-2007599

JOB NAME 408223	TRUSS NAME J20S	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:03:51 2020 Page 1

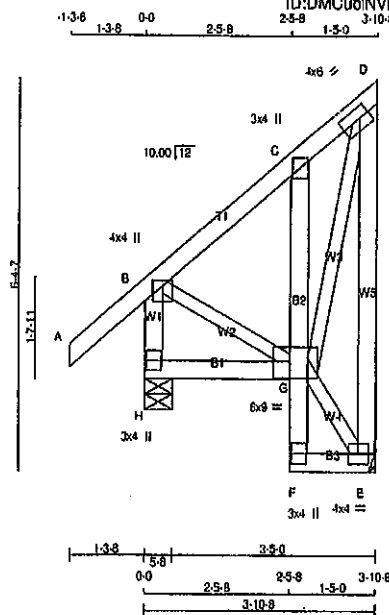

Scale = 1/32

TOTAL WEIGHT = 2 X 33 = 66 LB

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
H - B	2x4	DRY	No.2
A - D	2x4	DRY	No.2
H - G	2x4	DRY	No.2
F - C	2x4	DRY	No.2
F - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TMV+p	MT20	3.0	4.0		
D	TMWW-I	MT20	4.0	6.0	2.00	2.00
E	BMWW-I	MT20	4.0	4.0		
F	BMV+p	MT20	3.0	4.0		
G	BMWW-I	MT20	6.0	9.0	3.25	3.50
H	BMV+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
H	333	0	333	0	5-8
E	206	0	206	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	233	186	0	0	0	67	0
E	145	95	0	0	0	50	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
H-B	-309	0	0
A-B	0	41	0
B-C	-70	0	0
C-D	-92	0	0
H-G	0	0	0
F-G	0	12	0
G-C	-216	0	0
F-E	0	8	0

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.14/1.00 (A-B:5), BC=0.04/1.00 (G-H:4),
WB=0.08/1.00 (D-E:1), SS=0.09/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.24 (B) (INPUT = 0.90)
JSI METAL= 0.08 (C) (INPUT = 1.00)

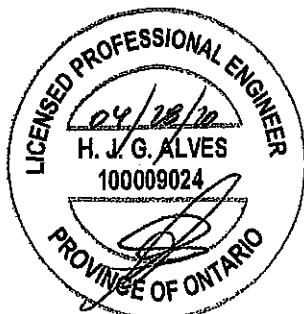

Structural component only
DWG# T-2007623



JSI GRIP = 0.28 (B) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)



JOB NAME
408223

TRUSS NAME
J22

QUANTITY
3

PLY
1

JOB DESC.
GREEN PARK HOMES

TRUSS DESC.

DRWG NO.

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:03:54 2020 Page 1

ID:DMCubINVR6TslFoe31v6I zns11-AbaD eX6b3bd9e1K874j4ubgIMZPN21Nv2FYKczMEMp

Scale = 1:27.0

Tamarack Roof Truss, Burlington

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	NO. 2
F - B	2x4	DRY	No. 2
A - C	2x4	DRY	No. 2
F - D	2x4	DRY	No. 2

ALL WEBS 2x3 DRY No. 2

DRY: SEASONED LUMBER

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")

CALCULATED VERT. DEFL. (LL) = L/999 (0.00")

ALLOWABLE DEFL. (RL) = L/360 (0.19")

CALCULATED VERT. DEFL. (RL) = L/999 (0.01")

CSI: TC=0.23 (1.00 (B-C:1), 8C=0.08 (1.00 (D-E:4), WB=0.00 (1.00 (B-E:1), SSI=0.11 (1.00 (B-C:1))

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (B) (INPUT = 0.90)

JSI METAL = 0.06 (B) (INPUT = 1.00)

BEARINGS

JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX
F	341	0	341	0	0	5-8	5-8	5-8
C	178	0	178	0	0	1-8	1-8	1-8
D	36	0	40	0	0	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS
F	239	170 0 0 0 0 0 0 0 0 0 0
C	122	99 0 0 0 0 0 0 0 0 0 0
D	29	0 0 0 0 0 0 0 0 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CS (LC)	MEMB. FORCE (LBS)
FR-TO	FROM TO	FROM TO	UNBRAC LENGTH	FR-TO
F-B	-305 0	0.0 0.0 0.03 (1)	7.81	B-E
A-B	0 41	-91.8 -91.8 0.14 (5)	10.00	
B-C	0 0	-91.8 -91.8 0.23 (1)	10.00	
F-E	0 0	-18.5 -18.5 0.08 (4)	10.00	
E-D	0 0	-18.5 -18.5 0.08 (4)	10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

LICENSED PROFESSIONAL ENGINEER

04/28/20


H. J. G. ALVES

100009024

PROVINCE OF ONTARIO

Structural component only

DWG# T-2007625

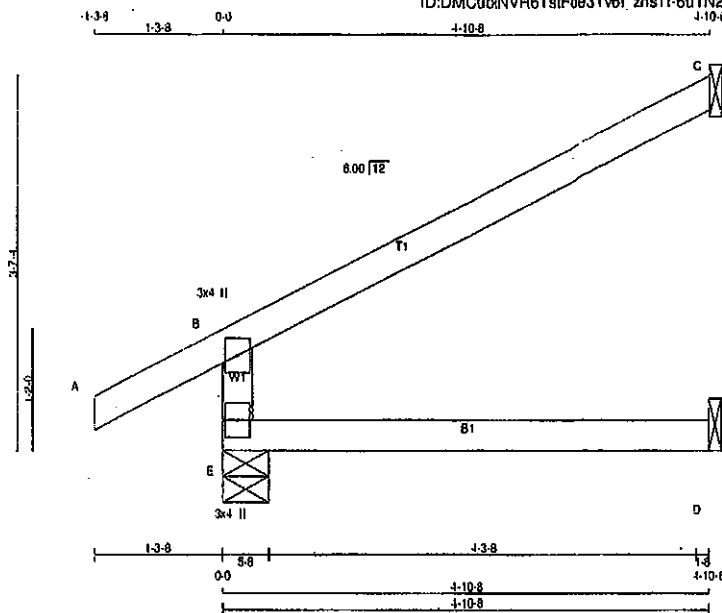Scale = 1:20.5

TOTAL WEIGHT = 2 X 14 = 28 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE		LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT IN-SX	IN-SX
E	456	0	456	0	0	5-8
C	168	0	168	0	0	1-8
O	38	0	42	0	0	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C.D.

UNFACTORED REACTIONS

1ST LGASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	320	225 0	0 0	0 0	0 0	95 0	0 0
C	116	94 0	0 0	0 0	0 0	22 0	0 0
D	30	0 0	0 0	0 0	0 0	30 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E. C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

LOADING
TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LCI (MAX)	CS1 (LC)	MAX. URB/BRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)	
FR-TO		FROM TO				FR-TO			
E-B	-104	0	0.0	0.0	0.08 (4)				
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00			
B-C	-25	0	-91.8	-91.8	0.37 (1)	8.25			
E-D	0	0	-18.5	-18.5	0.09 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD =		39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT OFF.

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF
LIVE LOAD

ALLOWABLE DEFL.(LL) = L 360 (0.19")
CALCULATED VERT. DEFL.(LL) = L 999 (0.00")
ALLOWABLE DEFL.(TL) = L 380 (0.19")
CALCULATED VERT. DEFL.(TL) = L 999 (0.02")

CSI: TC=0.37/1.00 (B-C:1), BC=0.08/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SSf=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIPIDRY (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

```
JSI GRIP= 0.17 (E) (INPUT = 0.90)
JSI METAL= 0.11 (B) (INPUT = 1.00)
```



Structural component only
DWG# T-2007657


JOB NAME 408224	TRUSS NAME J41	QUANTITY 5	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 26 10:19:54 2020 Page 1

ID:DMCubINVR6Tsf0e31v6I zns11-3Hb7Tu8HW1XPkAQqNkQj LMm1Em1EhglPom1zzME7p

Scale = 1:17.6

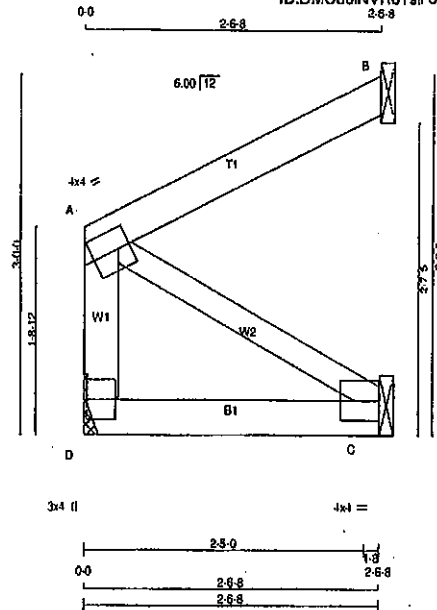

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
D - A	2x4	DRY	No.2
A - B	2x4	DRY	No.2
D - C	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW-1	MT20	4.0	4.0	2.00 1.25
C	BMW1-1	MT20	4.0	4.0	2.00 Edge
D	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
D	139	0	139	0	0
B	117	0	117	0	0
C	23	0	25	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINTS B, C.

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	98	65	0	0	0	33	0
B	80	65	0	0	0	15	0
C	18	0	0	0	0	18	0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
D-A	-117 0	A-C	0 0
A-B	0 0		
D-C	0 0		

TOTAL WEIGHT = 5 X 10 = 49 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2010
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.10 (1.00 (A-B:1) , BC=0.03 (1.00 (C-D:4) , WB=0.00 (1.00 (A-C:1) , SS=0.08 (1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 783 1957 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.07 (A) (INPUT = 0.90)
JSI METAL = 0.02 (A) (INPUT = 1.00)




Structural component only
DWG# T-2007658

DRWG NO.

ID:DMCubINVR6T9lFoe31v6l_zns1l-XT8WqE9yHKIGvK71xSq3XYurmlX_1hxqu3YvZPzME7c


Scale = 1:22.5



JSI GRIP = 0.15 (A) INPUT = 0.90
JSI METAL = 0.04 (A) INPUT = 1.00



Tamarack Roof Truss, Burlington

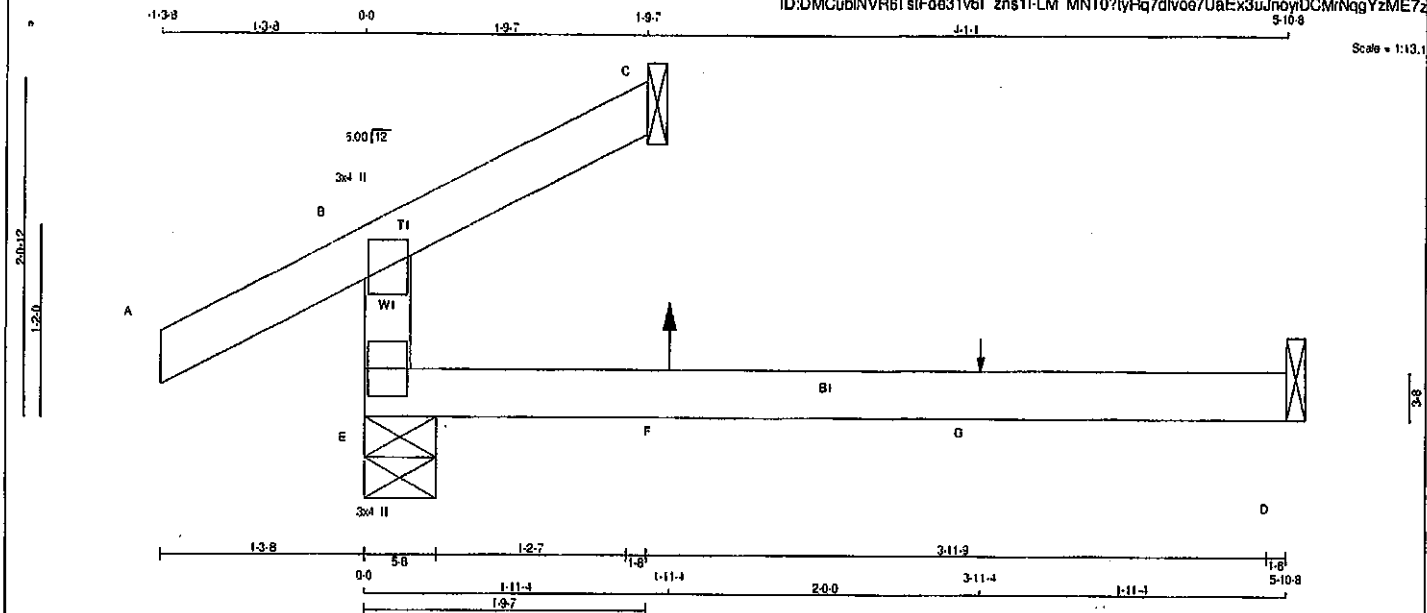

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER		MAXIMUM FACTORED		INPUT	REQ'D		
<u>BEARINGS</u>		GROSS REACTION		BRG	BRG		
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	284	0	284	0	0	5-8	5-8
C	83	0	83	0	0	1-8	1-8
O	44	0	52	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		MAX. MIN. COMPONENT REACTIONS					
JT	1ST CASE COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	200	137 0	0 0	0 0	0 0	62 0	0 0
C	46	21 0	0 0	0 0	0 0	25 0	0 0
D	35	0 .3	0 0	0 0	0 0	37 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E. C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (7)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LBS)	LC1 MAX UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX FACTORED CSI (LBS)
FR-TO		FROM TO			FR-TO		
E-B	-227 0	0.0	0.0	0.11 (4)			7.81
A-B	0 28	-91.8	-91.8	0.12 (1)			10.00
B-C	-9 9	-91.8	-91.8	0.08 (4)			10.00
E-F	0 0	-18.5	-18.5	0.14 (4)			10.00
F-G	0 0	-18.5	-18.5	0.14 (4)			10.00
G-D	0 0	-18.5	-18.5	0.14 (4)			10.00

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LOC	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	1-11-4	7	1	12	BACK	VERT	TOTAL	...	C1
G	3-11-4	1	1	...	BACK	VERT	TOTAL	...	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL	=	25.6 PSF
	DL	=	6.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.4 PSF
TOTAL LOAD		=	39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018 , OBC 2012 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF
LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/380 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4), WB=0.00/1.00 (avg:0), SS=-0.09/1.00 (A-B:1)

DOL LUMBER=0.98 NAIL=0.98 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES						
PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	818	354	1667	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.10 (E) INPUT = 0.90
JSI METAL= 0.06 (B) INPUT = 1.00



Structural component only
DWG# T-2007649

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C42	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:45 2020 Page 1
ID:DMCubINVR6TslFoe31v6I zns1I-pYYkap1esGPhnE6LLgJ7RUC2j9wh9SMbV7NC zME7Y

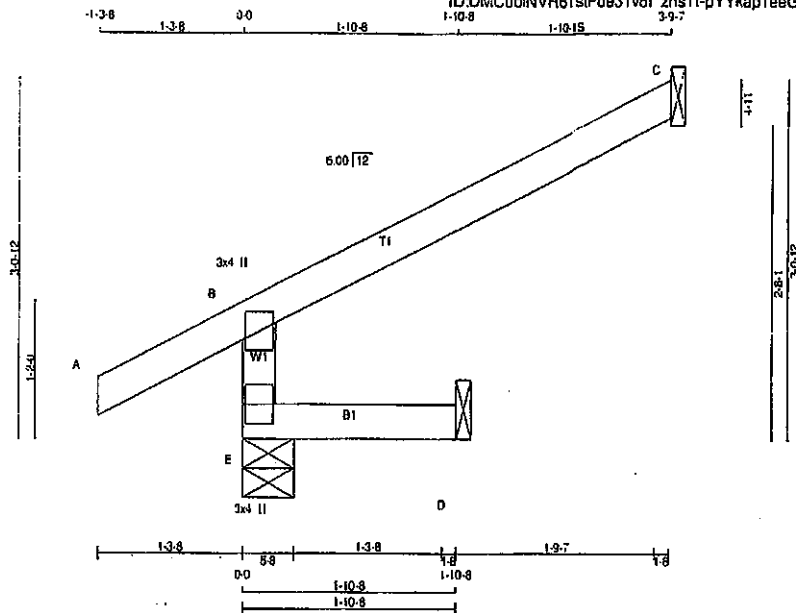

Scale = 1:18.2

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE		LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
E	391	0	361	0
C	130	0	130	0
D	18	0	17	0

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	MAX. MIN.	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	250	190	0	0	0	0	80	0
C	90	73	0	0	0	0	17	0
D	12	0	0	0	0	0	12	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED		MEMB.	MAX. FACTORED		
	FORCE	VERT. LOAD	LC1 MAX		FORCE	MAX	
	(LBS)	(PLF)	CSI(LC)		(LBS)	CSI(LC)	
FR-TO		FROM TO		FR-TO			
E-B	-342	0	0.0	0.0	0.01 (4)	7.81	
A-B	0	28	-91.8	-91.8	0.13 (5)	10.00	
B-C	-19	0	-91.8	-91.8	0.22 (1)	6.25	
E-D	0	0	-18.5	-18.5	0.02 (4)	10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19')
CALCULATED VERT. DEFL.(LL) = L/999 (0.00')
ALLOWABLE DEFL.(TL) = L/360 (0.19')
CALCULATED VERT. DEFL.(TL) = L/999 (0.00')

CSI: TC=0.22(1.00 (B-C:1), BC=0.02(1.00 (D-E:4), WB=0.00(1.00 (max:0), SSI=0.15(1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	818	354	1607
		788	1987
			1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP=0.14 (E) (INPUT = 0.90)
JSI METAL=0.09 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007650

Structural component only
DWG# T-2007651

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C44	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 8 Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:47 2020 Page 1	

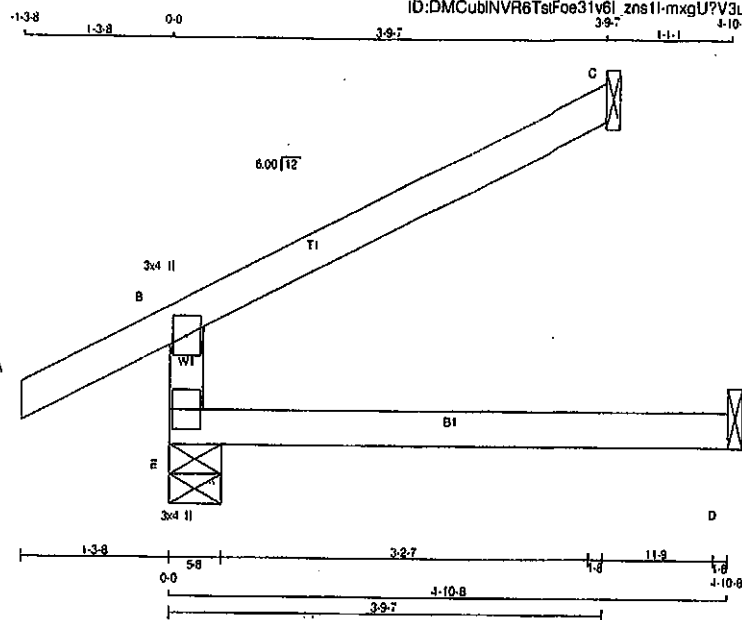

TOTAL WEIGHT = 2 X 13 = 26 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
E - B	2x4	DRY No.2
A - C	2x4	DRY No.2
E - D	2x4	DRY No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT 8RG	REQD 8RG
JT	VERT	HORZ	DOWN	HORZ
E	394	0	394	0
C	130	0	130	0
D	38	0	42	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	277	190	0	0	0	87	0
C	90	73	0	0	0	17	0
D	30	0	0	0	0	30	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH	WEBS	MAX. FACTORED FORCE (LBS)
FR-TO						
E-B	-342	0	0.0	0.09 (4)	7.81	
A-B	0	28	-91.8	-91.8 0.12 (1)	10.00	
B-C	-19	0	-91.8	-91.8 0.22 (1)	6.25	
E-D	0	0	-18.5	-18.5 0.09 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.22:1.00 (B-C:1), BC=0.09:1.00 (D-E:4), WB=0.00:1.00 (max), SSI=0.15:1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.14 (E) INPUT = 0.90
JSI METAL = 0.09 (B) INPUT = 1.00



Structural component only
DWG# T-2007652


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C45	2	1	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 26 10:19:48 2020 Page 1

ID:DMCubINVR6TslFos3iv6l_zns1l-E7DsCr3WxBnFcFyglUCQI46kwwAMuWC0HTL1pJzME7v

Scale = 1:1.1

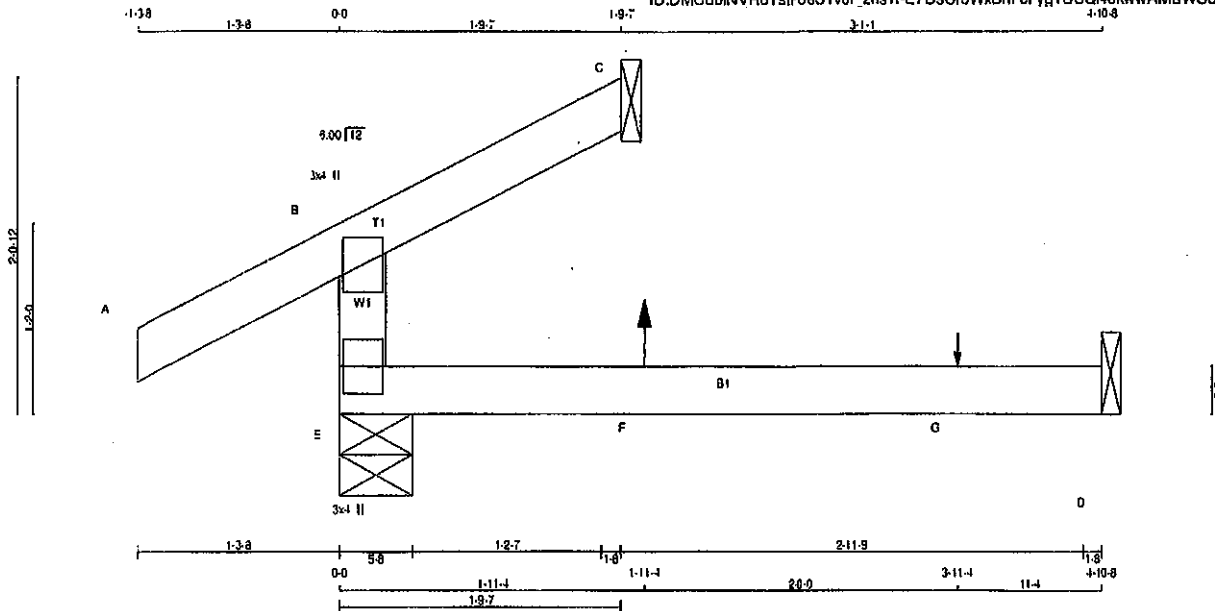

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2			SPF
A - C	2x4	DRY	No.2			SPF
E - D	2x4	DRY	No.2			SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0			
E	BMV1+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	GROSS REACTION	MAXIMUM FACTORED	INPUT	RECORD
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
E	282	0	282	0	0
C	55	0	55	0	0
D	35	0	44	0	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	188	137	0	0	0	0	61	0
C	39	21	0	0	0	0	18	0
D	29	0	4	0	0	0	31	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (7)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD	LC1	MAX.
FR-TO	(LBS)	(PLF)	CS1 (LC)	UNBRAC
E-B	-235	0	0.0	0.07 (4)
A-B	0	26	-91.8	-91.8 0.12 (1)
B-C	-13	5	-91.8	-91.8 0.07 (5)
E-F	0	0	-18.5	-18.5 0.10 (4)
F-G	0	0	-18.5	-18.5 0.10 (4)
G-D	0	0	-18.5	-18.5 0.10 (4)

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
F	1-11-4	7	1	12	BACK	VERT	TOTAL	---	C1
G	3-11-4	1	1	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.12(1.00) (A-B:1), BC=0.10(1.00) (D-E:4),
WB=0.00(1.00) (n/a:0), SSI=0.09(1.00) (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1907 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 6.0 Deg.

JSI GRIP= 0.10 (E) INPUT = 0.90
JSI METAL= 0.07 (B) INPUT = 1.00




Structural component only
DWG# T-2007653

JOB NAME 408224	TRUSS NAME C46	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:49 2020 Page 1
ID:DMCubINVR6TslFoe31v8l zns11-lJnEQB48hUv6EPXlaBjHfHfukKVjdZSxW75bLzME7U

Scale = 1:18.2

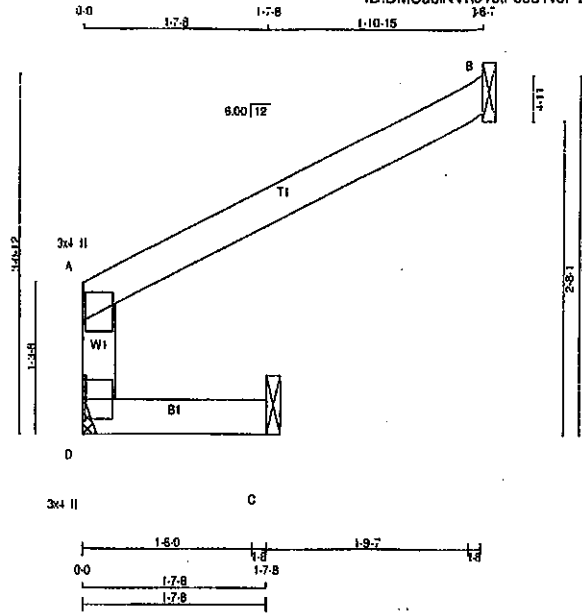

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.	SPF
D - A	2x4	DRY	No.2				
A - B	2x4	DRY	No.2				
D - C	2x4	DRY	No.2				

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0			
D	BMV+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
D	156	0	156	0
B	144	0	144	0
C	55	0	55	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B..C

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	109	78	0	0	0	0	31	0
B	99	80	0	0	0	0	19	0
C	40	23	0	0	0	0	17	0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: 14)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO		FR-TO		
D-A	-181 0	0.0	0.0	0.09 (1)		7.81	
A-B	-3 0	-91.8	-91.8	0.14 (1)		10.00	
D-C	0 0	-18.5	-18.5	0.09 (1)		10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/899 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/899 (0.00")

CSI: TC=0.14/1.00 (A-B:1), BC=0.09/1.00 (C-D:1), WB=0.00/1.00 (n/a:0), SS=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.08 (D) INPUT = 0.80
JSI METAL = 0.05 (A) INPUT = 1.00



Structural component only
DWG# T-2007654


JOB NAME 408224	TRUSS NAME C47	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 M&T Tek Industries, Inc. Tue Apr 28 10:18:50 2020 Page 1

ID:DMCubINVR6TslFoe31v6f zns11-AWLddX5mSo1zrY638uEuqVB5ske7MQi5knq8uCzME7t

Scale = 1:13.1

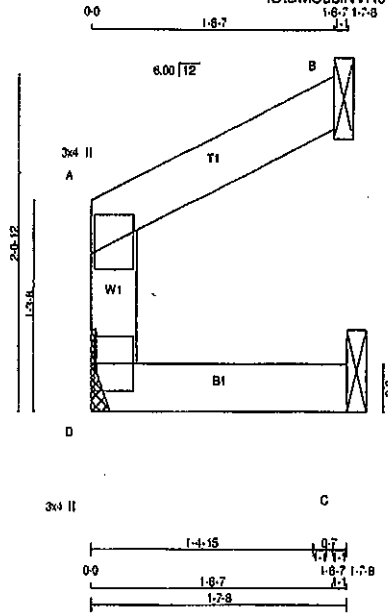

TOTAL WEIGHT = 5 lb
(M/F)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
D - A	2x4	DRY	No.2	SPF	
A - B	2x4	DRY	No.2	SPF	
D - C	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0			
D	BMV1+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	DOWN	UPLIFT
D	86	0	86	0
B	67	0	67	0
C	19	0	19	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINTS B, C

UNFACTORED REACTIONS

1ST LGASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	61	39	0	0	0	21	0
B	46	37	0	0	0	9	0
C	14	2	0	0	0	12	0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO			FR-TO		
D-A	-74 0	0.0 0.0	0.01 (1)	7.81			
A-B	-2 0	-91.8 -91.8	0.03 (1)	10.00			
D-C	0 0	-18.5 -18.5	0.01 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19')
CALCULATED VERT. DEFL. (LL) = L/999 (0.00')
ALLOWABLE DEFL. (TL) = L/360 (0.19')
CALCULATED VERT. DEFL. (TL) = L/999 (0.00')

CSI: TC=0.03 (A-B:1), BC=0.01 (1.00 (C-D:4), WB=0.00 (1.00 (A-B:1), SSI=0.05 (1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.03 (D) INPUT = 0.90
JSI METAL= 0.02 (A) INPUT = 1.00



Structural component only
DWG# T-2007655

LUL/LUS/LJS/HUS/HHUS/HGUS

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.


Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.84 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options Information on p. 126.

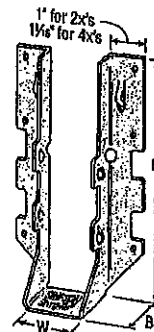


LUS28




LU26L

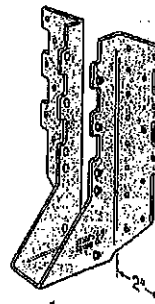


HUS210
(HUS26, HUS28,
and HHUS similar)

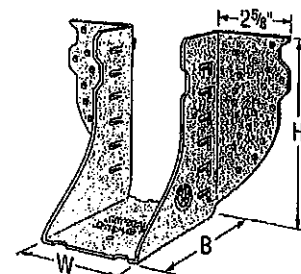


HGUS28-2




HHUS210-2



Double-Shear
Nailing
Top View





Double-Shear
Nailing
Side View;
Do not
bend tab



Dome Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,803,560

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

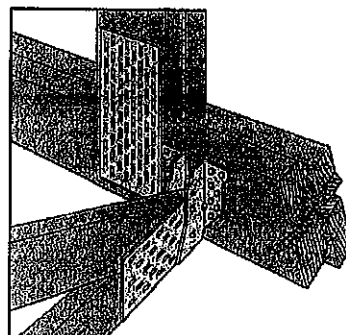

LJS26DS

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options Information on pp. 125–127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
$W < 2"$	Bevel or square cut	0.62 of table value	0.46 of table value
$2" < W < 6"$	Bevel cut	0.67 of table value	0.41 of table value
$2" < W < 6"$	Square cut	0.46 of table value	0.41 of table value
$W > 6"$	Bevel cut	0.75 of table value	0.41 of table value

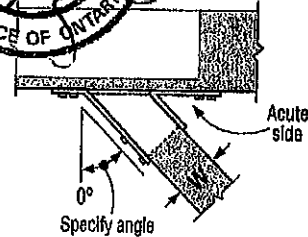

Top View HHUS Hanger Skewed Right
(joist must be bevel cut)
All joist nails installed on the outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance				
		W	H	B	d _g ³	Header	Joist	D-Fir-L		S-P-F		
								Uplift	Normal	Uplift	Normal	
								(K _D = 1.15) lb.	(K _D = 1.00) lb.	(K _D = 1.15) lb.	(K _D = 1.00) lb.	
								kN	kN	kN	kN	
Single 2x Sizes												
■	LUS24	18	1 1/8	3 1/4	1 1/4	2 1/4	(4) 10d	(2) 10d	710	1625	645	1155
									3.18	7.23	2.87	5.14
■	LU24L	22	1 1/8	3	1 1/4	2 1/4	(4) 10d	(2) 10d x 1 1/2"	360	1020	320	725
									1.60	4.54	1.42	3.22
■	LU26L	22	1 1/8	5	1 1/4	4 1/4	(6) 10d	(4) 10d x 1 1/2"	720	1605	645	1140
									3.20	7.14	2.87	5.07
SS	LUS26	18	1 1/8	4 1/4	1 1/4	3 1/4	(4) 10d	(4) 10d	1420	2170	1290	1830
									6.32	9.65	5.74	7.25
■	HUS26	18	1 1/8	5 1/4	3	3 1/4	(14) 16d	(6) 16d	2705	4940	2065	3875
									11.80	21.97	9.20	17.24
■	LJS26DS	18	1 1/8	5	3 1/4	4 1/4	(16) 16d	(6) 16d	2055	4265	1460	4115
									9.14	18.97	6.49	18.31
■	HGUS26	12	1 1/8	5 1/4	5	4 1/4	(20) 16d	(8) 16d	2885	6625	2685	5700
									11.96	28.51	11.98	25.35
■	LU28L	20	1 1/8	6 1/4	1 1/4	5 1/4	(8) 10d	(6) 10d x 1 1/2"	1140	2185	1020	1550
									5.07	9.72	4.54	6.89
SS	LUS28	18	1 1/8	6 1/4	1 1/4	3 1/4	(8) 10d	(4) 10d	1420	2520	1290	1790
									6.32	11.21	5.74	7.96
■	HUS28	16	1 1/8	7 1/4	3	6 1/4	(22) 16d	(8) 16d	3605	5365	2675	4345
									16.04	23.88	11.90	19.33
■	HGUS28	12	1 1/8	7 1/4	5	6 1/4	(36) 16d	(12) 16d	3310	7675	3310	6900
									14.74	34.19	14.74	30.73
■	LU210L	20	1 1/8	8	1 1/4	7 1/4	(10) 10d	(8) 10d x 1 1/2"	1140	2495	1020	1770
									5.07	11.10	4.54	7.87
SS	LUS210	18	1 1/8	7 1/4	1 1/4	3 1/4	(8) 10d	(4) 10d	1420	2785	1290	2210
									6.32	12.39	5.74	9.83


1. Factored uplift resistances have been increased 16% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_g is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girdler truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSON and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _s	Header	Joist	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _g = 1.15) lb.	(K _g = 1.00) lb.	(K _g = 1.15) lb.	(K _g = 1.00) lb.
								kN	kN	kN	kN
Double 2x Sizes											
LUS24-2	18	3 3/8	3 3/8	2	1 1/2	(4) 16d	(2) 16d	835	2020	580	1435
LUS26-2	18	3 3/8	4 3/8	2	4	(4) 16d	(4) 16d	3.71	8.99	2.62	6.38
								1720	2505	1545	1920
HHUS26-2	14	3 3/8	5 3/8	3	3 15/16	(14) 16d	(6) 16d	7.05	11.54	6.87	8.54
								2850	7335	2085	5205
HGUS26-2	12	3 3/8	5 3/8	4	4 1/4	(20) 16d	(8) 16d	12.68	32.83	9.20	23.15
								4385	8950	3110	6355
LUS28-2	18	3 3/8	7	2	4	(6) 16d	(4) 16d	19.51	39.81	13.83	28.27
								1720	3325	1545	2675
HHUS28-2	14	3 3/8	7 3/8	3	6 3/8	(22) 16d	(8) 16d	7.65	14.79	6.87	11.45
								3765	8940	2675	6345
HGUS28-2	12	3 3/8	7 3/8	4	8 1/4	(36) 16d	(12) 16d	16.75	39.77	11.90	28.22
								6070	12980	4310	9215
LUS210-2	18	3 3/8	9	2	6	(8) 16d	(6) 16d	27.00	57.74	19.17	40.99
								2680	4500	2320	3195
HHUS210-2	14	3 3/8	9 3/8	3	8	(30) 16d	(10) 16d	11.48	20.02	10.32	14.21
								4670	9600	4235	7000
HGUS210-2	12	3 3/8	9 3/8	4	8 1/2	(46) 16d	(16) 16d	20.77	42.97	18.84	31.14
								6840	14015	4855	10270
								30.43	62.34	21.60	45.69
Triple 2x Sizes											
HGUS26-3	12	4 1/8	5 1/2	4	4 1/4	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-3	12	4 1/8	7 1/4	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d	4670	9670	4235	6865
								20.77	43.02	18.84	30.64
HGUS210-3	12	4 1/8	9 1/4	4	8 3/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.26
Quadruple 2x Sizes											
HGUS26-4	12	6 1/8	5 3/8	4	4 1/4	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-4	12	6 1/8	7 3/8	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-4	14	6 1/8	8 3/8	3	7 1/8	(30) 16d	(10) 16d	4670	10155	4235	7210
								20.77	45.17	18.84	32.07
HGUS210-4	12	6 1/8	9 3/8	4	8 3/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.26
HGUS212-4	12	6 1/8	10 3/8	4	10 1/8	(56) 16d	(20) 16d	7640	14995	5425	10645
								33.98	66.70	24.13	47.35
HGUS214-4	12	6 3/8	12 3/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	51.80
4x Sizes											
LUS46	18	3 3/8	4 3/8	2	3 3/8	(4) 16d	(4) 16d	1720	2595	1545	1920
								7.65	11.54	6.87	8.54
HHUS46	14	3 3/8	5 1/4	3	3 15/16	(14) 16d	(6) 16d	2540	7335	2085	5205
								11.30	32.83	9.20	23.15
HGUS46	12	3 3/8	5 1/4	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
LUS48	18	3 3/8	6 3/8	2	3 3/8	(6) 16d	(4) 16d	1720	3325	1545	2675
								7.65	14.79	6.87	11.45
HHUS48	14	3 3/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3765	8940	2675	6345
								16.75	39.77	11.90	28.22
HGUS48	12	3 3/8	7 1/8	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
LUS410	18	3 3/8	8 3/8	2	5 1/8	(8) 16d	(6) 16d	2580	4500	2320	3195
								11.48	20.02	10.32	14.21
HGUS410	12	3 3/8	9	4	8 3/8	(16) 16d	(16) 16d	6840	14015	4855	10270
								30.43	62.34	21.60	45.69
HGUS412	12	3 3/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	7640	14995	5425	10645
								33.98	66.70	24.13	47.35
HGUS414	12	3 3/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	51.80



Plated Truss Connectors

See footnotes
on p. 258.

TC – Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1¼". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1½" = 0.148" dia. x 1½" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

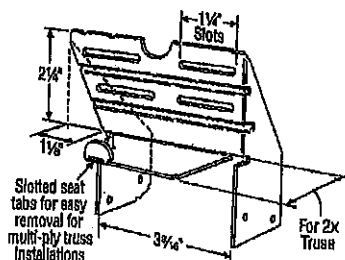


TC24
U.S. Patent 4,932,173

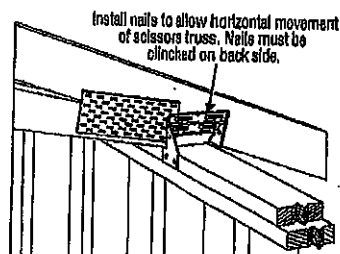


Typical TC24 Installation

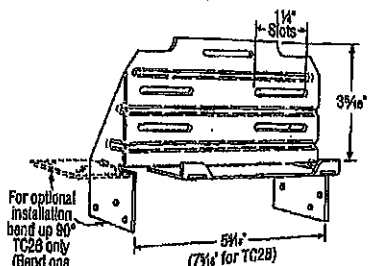

TC26
(TC28 Similar)

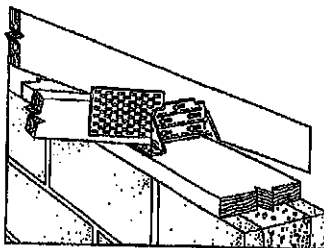

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer (8", 10", 12" Wall Installation Similar)

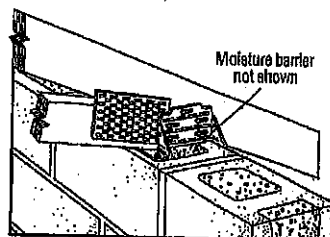

Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Trusses	Wall Plates	D-Fir-L Uplift (K _u =1.15)	S-P-F Uplift (K _u =1.15)
			lb.	lb.
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(6) 10d	1015	720
TC28	(5) 10d	(8) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D-Fir-L Uplift (K _u =1.15)	S-P-F Uplift (K _u =1.15)
			lb.	lb.
TC26	(5) 10d	(8) 10d x 1½"	810	660
	(5) 10d	(6) 10d	930	660

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.

2. Grout strength is 15 MPa minimum.

3. Optional TC26 installation with 10d nails requires minimum 3" top plate thickness.

4. TC26 fastened to grouted concrete block with (8) - 9/16" x 2¼" Titen screws has a factored uplift resistance of 276 lb.



DESIGN

(800) 999-5099
strongtie.com

H/TSP

SIMPSON
Strong-Tie

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_D = 1.15$)					
					D.Fir-L			S-P-F		
		To Rafters/Truss	To Plates	To Studs	Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(5) 8d x 1½"	(4) 8d	—	740	685	300	680	485	216
					3.29	3.05	1.33	3.02	2.16	0.98
SS H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	890	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
					3.58	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	180	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	265	615	125	190
					3.29	0.80	1.18	2.74	0.56	0.86
H6	16	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	870	—	990	475	—
					6.18	2.88	—	4.40	2.11	—
SS H8 ³	18	(5) 10d x 1½"	(5) 10d x 1½"	—	1120	—	—	1025	—	—
					4.98	—	—	4.56	—	—
SS H10A ⁹	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	565	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.64	1.36
H10A-2	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1835	1275	430	1645	880	305
					8.18	5.67	1.91	7.32	3.91	1.36
H10S ^{7,8}	18	(8) 8d x 1½"	(8) 8d x 1½"	(8) 8d	1465	795	315	1040	565	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2½"	(6) 16d x 2½"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	① (12) 8d x 1½"	(13) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
		② (12) 8d x 1½"	(15) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
TSP	16	(9) 10d x 1½"	(6) 10d x 1½"	—	1295	440	—	920	310	—
					5.76	1.98	—	4.09	1.38	—
		(9) 10d x 1½"	(6) 10d	—	1560	440	—	1105	310	—
					6.94	1.98	—	4.92	1.38	—

- Factored resistances have been increased 15% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 595 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 6/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCN® ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1½" nails into the top plates and (3) 8d x 1½" nails into the lowest three flange holes into the truss bottom chord is 485 lb. (2.20 kN).
- Nails: 16d x 2½" = 0.162" dia. x 2½" long, 10d = 0.148" dia. x 3" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long, 8d x 1½" = 0.131" dia. x 1½" long. See pp. 27-28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.180	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

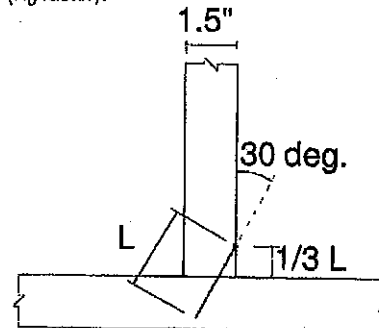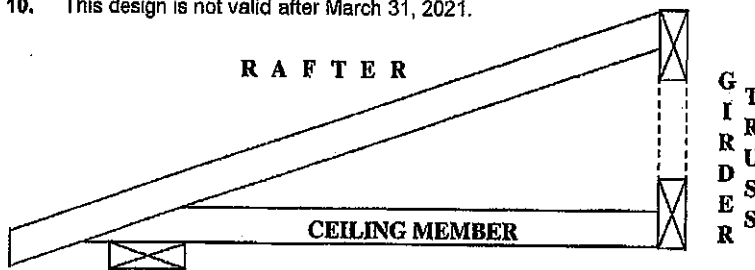


TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019

PEO
Certificate No. 10889485



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind** or **earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37679H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.


Toe-nailing on 2x6 Bearing Plate

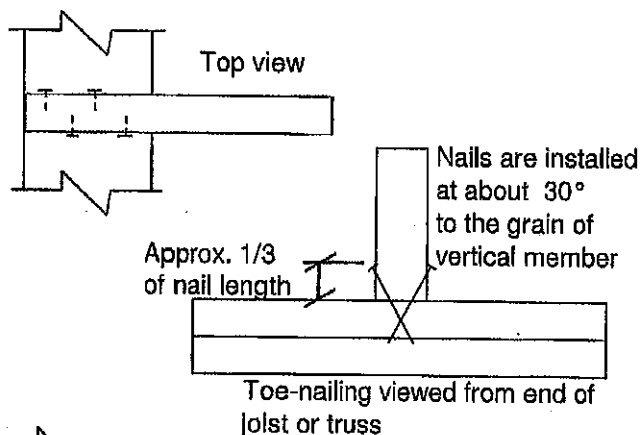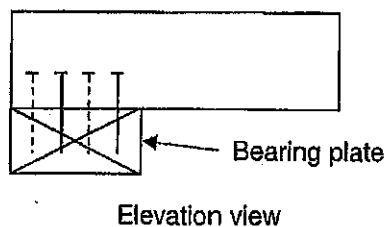

Toe-nailing on 2x4 Bearing Plate

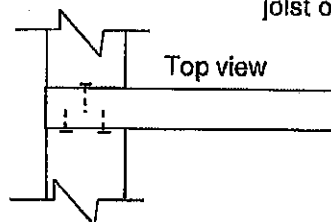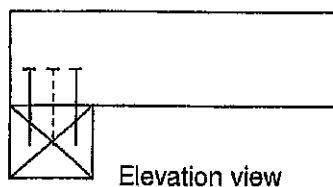


MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7




December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint, unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/4" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm. (Drawings not to scale)

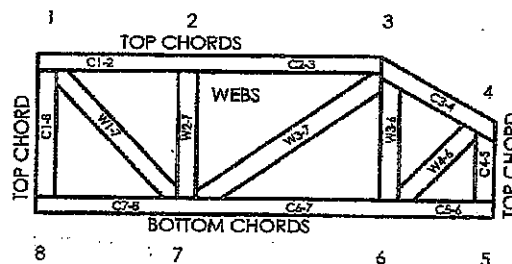

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MIT-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane of joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing of 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected ovetop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

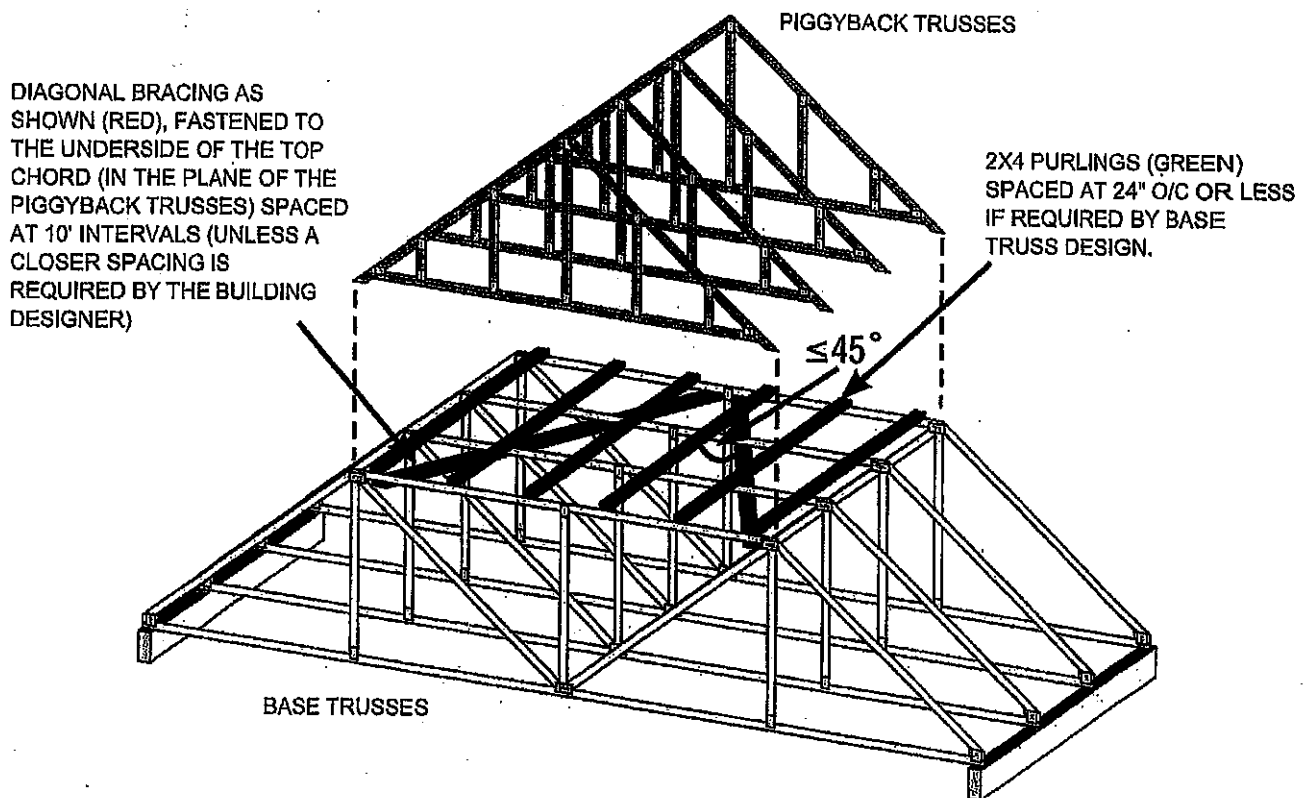


NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufacturer's responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1800213

Feb 09, 2018