



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 6
 Lot #: 260
 Elevation: 3- STD OR OPT.5 BR

Job Track: 51225
 PlanLog: 202419
 Layout ID: 408224
 Ref #
 Page: 1 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T40 Hip Girder	6 / 12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	337.58 208.00		
	1 2-ply	T40Z Hip Girder	6 / 12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	337.58 208.00		
	2	T41 Hip	6 / 12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.99 174.00		
	2	T42 Hip	6 / 12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.12 174.67		
	2	T43 Hip	6 / 12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	289.07 179.67		
	2	T44 Hip	6 / 12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	290.73 183.33		
	2	T45 Hip	6 / 12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	301.67 191.33		
	8	T46 Common	6 / 12	35-02-00	9-11-08	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1178.98 725.33		
	2	T47S Roof Special	0 / 12	10-06-00	3-08-00	2 x 4		3-08-00 3-08-00	101.09 63.67		
	1	T48 Half Hip	6 / 12	10-06-00	2-08-00	2 x 4	1-03-08	1-02-00 2-08-00	39.94 26.67		
	1	T49 Half Hip	6 / 12	10-06-00	3-08-00	2 x 4	1-03-08	1-02-00 3-08-00	41.91 27.50		
	2	T50 Flat	0 / 12	5-07-00	3-00-00	2 x 4		3-00-00 3-00-00	45.54 30.00		
	1	G50 GABLE	0 / 12	5-07-00	3-00-00	2 x 4		3-00-00 3-00-00	22.18 15.00		
	1	T51 Hip Girder	6 / 12	10-05-00	3-07-04	2 x 4	1-03-08	1-02-00 1-03-08	43.52 29.67		




DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 6
 Lot #: 260
 Elevation: 3- STD OR OPT.5 BR

Job Track: 51225
 PlanLog: 202419
 Layout ID: 408224
 Ref #
 Page: 2 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T52 Hip	6 / 12	10-05-00	4-00-00	2 x 4	1-03-08	2-02-00 2-03-08	45.94 29.83		
	1	T53 Hip Girder	6 / 12	10-05-00	3-00-00	2 x 4	1-03-08	2-02-00 2-03-08	46.32 31.83		
	1 2-ply	T54S Roof Special Girder	0 / 12	10-06-08	2-02-00	2 x 4 2 x 6		1-02-00 2-02-00	97.7 64.33		
	18	J1 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	302.3 192.00		
	2	J40 Jack-Open	6 / 12	4-10-08	3-07-04	2 x 4	1-03-08	1-02-00 3-07-04	28.76 18.67		
	5	J41 Jack-Open	6 / 12	2-06-08	3-00-00	2 x 4		1-08-12 3-00-00	49.19 34.17		
	2	J42 Jack-Open	6 / 12	5-05-08	4-01-04	2 x 4		1-04-08 4-01-04	31.44 20.67		
	2	C40 Jack-Open	6 / 12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	28.26 17.33		
	2	C41 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	23.16 14.67		
	3	C42 Jack-Open	6 / 12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	28.71 18.00		
	3	C43 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	21.08 14.00		
	2	C44 Jack-Open	6 / 12	3-09-07	3-00-12	2 x 4	1-03-08 1-01-01	1-02-00 3-00-12	25.98 16.00		
	2	C45 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 3-01-01	1-02-00 2-00-12	20.88 13.33		
	1	C46 Jack-Open	6 / 12	1-07-08	3-00-12	2 x 4	1-10-15	1-03-08 2-01-04	7.46 5.33		

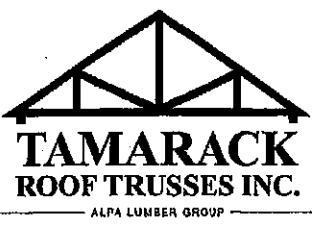 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: MOUNTAINASH 6 Lot #: 260 Elevation: 3- STD OR OPT.5 BR	Job Track: 51225 PlanLog: 202419 Layout ID: 408224 Ref # Page: 3 of 3 Date: 04-27-2020 Designer: Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	C47 Jack-Open	6 /12	1-07-08	2-00-12	2 x 4		1-03-08 2-01-04	4.91 3.33		


TOTAL # TRUSS= 77 TOTAL BFT OF ALL TRUSSES= 2730.33 BFT. TOTAL WEIGHT OF ALL TRSSES 4346.93 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	HGUS26-2	
1	Hardware	LJS28DS	
14	Hardware	LUS24	
2	Hardware	LUS26-2	

TOTAL NUMBER OF
ITEMS= 18

JOB NAME 408222	TRUSS NAME T1	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:04 2020 Page 1	
				ID:DMCubINVR6TsFoe31v6l zns11-Jm9J91AhZ122g2EEminZsZ3HThi?mEdCAUuvczMFH	
Scale = 1:57.6					

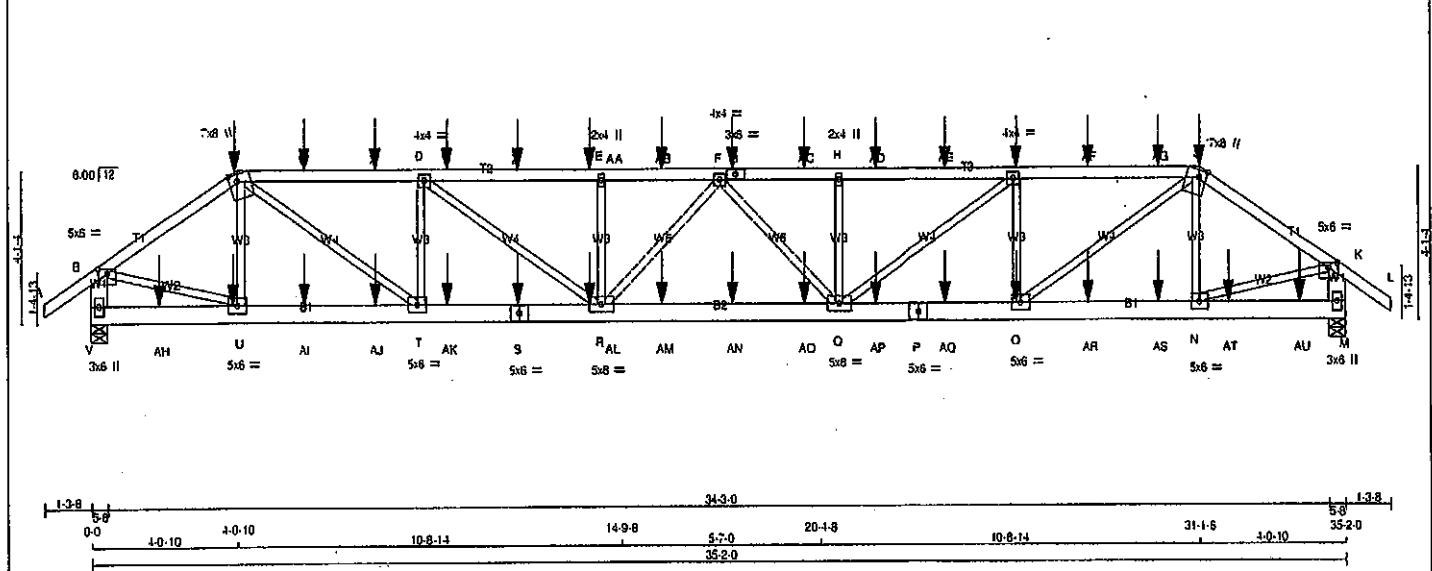

TOTAL WEIGHT = 2 X 161 = 323 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - G	2x4	DRY	No.2
G - J	2x4	DRY	No.2
J - L	2x4	DRY	No.2
V - B	2x6	DRY	No.2
M - K	2x6	DRY	No.2
V - S	2x6	DRY	No.2
S - P	2x6	DRY	No.2
P - M	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C	12	SIDE(61.0)
C-G	12	SIDE(61.0)
G-J	12	SIDE(61.0)
J-L	12	SIDE(61.0)
V-B	2	TOP
M-K	2	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
V-S	2	SIDE(183.1)
S-P	2	SIDE(183.1)
P-M	2	SIDE(183.1)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY

GIRDER MAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT GROSS REACTION	RECORD GROSS REACTION
JT	VERT	0	0	0	0
V	HORZ	3393	0	5-8	5-8
M	HORZ	3342	0	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
V	2397	1585	0	0	0	812	0
M	2363	1555	0	0	0	808	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.11 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT.	LC1	MEMB.	FORCE (LBS)	VERT.	LC1
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 35	-91.8	-91.8 0.07 (1)	U-C	-820 0	0.08 (1)	
B-C	-4024 0	-91.8	-91.8 0.22 (1)	C-T	0 3389	0.42 (1)	
C-W	-8074 0	-91.8	-91.8 0.53 (1)	T-D	-1848 0	0.23 (1)	
W-X	-8074 0	-91.8	-91.8 0.53 (1)	O-I	-1869 0	0.24 (1)	
X-D	-8074 0	-91.8	-91.8 0.53 (1)	O-J	0 3425	0.42 (1)	
D-Y	-7423 0	-91.8	-91.8 0.83 (1)	N-J	-601 0	0.08 (1)	
Y-Z	-7423 0	-91.8	-91.8 0.83 (1)	B-U	0 3437	0.43 (1)	
Z-AA	-7423 0	-91.8	-91.8 0.83 (1)	N-K	0 3371	0.42 (1)	
AA-E	-7423 0	-91.8	-91.8 0.83 (1)	Q-I	0 1704	0.21 (1)	
E-AB	-7423 0	-91.8	-91.8 0.35 (1)	D-R	0 1677	0.21 (1)	
AB-F	-7423 0	-91.8	-91.8 0.35 (1)	Q-H	-595 0	0.08 (1)	
F-G	-7410 0	-91.8	-91.8 0.36 (1)	R-E	-594 0	0.08 (1)	
G-AC	-7410 0	-91.8	-91.8 0.38 (1)	R-F	-285 0	0.08 (1)	
AC-H	-7410 0	-91.8	-91.8 0.38 (1)	F-Q	-305 0	0.08 (1)	
H-AD	-7410 0	-91.8	-91.8 0.81 (1)				
AD-AE	-7410 0	-91.8	-91.8 0.81 (1)				
AE-I	-7410 0	-91.8	-91.8 0.81 (1)				
I-AF	-6040 0	-91.8	-91.8 0.51 (1)				
AF-AG	-6040 0	-91.8	-91.8 0.51 (1)				
AG-J	-3948 0	-91.8	-91.8 0.22 (1)				
K-L	0 35	-91.8	-91.8 0.07 (1)				
V-B	-3355 0	0.0	0.0 0.12 (1)				
M-K	-3298 0	0.0	0.0 0.12 (1)				

V-AH	0 0	-18.5	-18.5 0.04 (4)	10.00
AH-U	0 0	-18.5	-18.5 0.04 (4)	10.00
U-AI	0 3328	-18.5	-18.5 0.25 (1)	10.00
AI-AJ	0 3328	-18.5	-18.5 0.25 (1)	10.00
AJ-T	0 3328	-18.5	-18.5 0.25 (1)	10.00
T-AK	0 8074	-18.5	-18.5 0.45 (1)	10.00
AK-S	0 8074	-18.5	-18.5 0.45 (1)	10.00
S-AL	0 8074	-18.5	-18.5 0.45 (1)	10.00
AL-R	0 8074	-18.5	-18.5 0.45 (1)	10.00
R-AM	0 7613	-18.5	-18.5 0.57 (1)	10.00
AM-AN	0 7613	-18.5	-18.5 0.57 (1)	10.00
AN-AO	0 7613	-18.5	-18.5 0.57 (1)	10.00
AO-Q	0 7613	-18.5	-18.5 0.57 (1)	10.00
Q-AP	0 6040	-18.5	-18.5 0.45 (1)	10.00
AP-P	0 6040	-18.5	-18.5 0.45 (1)	10.00
P-AQ	0 6040	-18.5	-18.5 0.45 (1)	10.00
AQ-O	0 6040	-18.5	-18.5 0.45 (1)	10.00
O-AR	0 3261	-18.5	-18.5 0.25 (1)	10.00

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
OL = 6.0 PSF
BOT CH. LL = 0.0 PSF
OL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (11.17)
CALCULATED VERT. DEFL.(LL) = L/999 (0.23")
ALLOWABLE DEFL.(TL) = L/360 (11.17)
CALCULATED VERT. DEFL.(TL) = L/970 (0.44")

CS1 TC=0.63(1.00)(D-E:1), BC=0.57(1.00)(O-R:1), WB=0.43(1.00)(B-U:1), SSI=0.19(1.00)(G-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (i) (INPUT = 0.90)
JSI METAL = 0.58 (i) (INPUT = 1.00)

CONTINUED ON PAGE 2



Structural component only
DWG# T-2007602 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T1	1	2	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 6.310 S Oct 29 2019 M&T Industries, Inc. Tue Apr 28 09:00:04 2020 Page 2
ID:DMCubINVR6TsFoe31v6I zns11-Jm9J91AhZ122o2EEmlNZsEz3HThI?mEdCAUuvoczMFII

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMW-w	MT20	5.0	6.0	1.50	3.00
C TTWW+m	MT20	7.0	8.0	Edge	2.50
D, F, I					
D TMW-w	MT20	4.0	4.0		
E TMW-w	MT20	2.0	4.0		
G TS-1	MT20	3.0	6.0		
H TMW-w	MT20	2.0	4.0		
J TTWW+m	MT20	7.0	8.0	Edge	2.50
K TMW-w	MT20	5.0	6.0	1.50	3.00
M BMV1+p	MT20	3.0	6.0		
N, O, T, U					
N BMW-w	MT20	5.0	6.0		
P BS-1	MT20	5.0	6.0		
Q BMW-w	MT20	5.0	8.0		
R BMW-w	MT20	5.0	8.0		
S BS-1	MT20	5.0	6.0		
V BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING
TOTAL LOAD CASES: 14)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
AR-AS	0 3261	-18.5	-18.5 0.25 (1)	10.00			
AS-N	0 3261	-18.5	-18.5 0.25 (1)	10.00			
N-AT	0 0	-18.5	-18.5 0.04 (4)	10.00			
AT-AU	0 0	-18.5	-18.5 0.04 (4)	10.00			
AU-M	0 0	-18.5	-18.5 0.04 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FAGE	DIR.	TYPE	HEEL	CONN.
C	4-0-10	-49	-55	---	FRONT	VERT	DEAD	---	C1
C	4-0-10	-117	-117	---	FRONT	VERT	TOTAL	---	C1
C	4-0-10	-254	-254	---	FRONT	VERT	SNOW	---	C1
G	17-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
I	25-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
J	31-1-8	-49	-55	---	FRONT	VERT	DEAD	---	C1
J	31-1-8	-254	-254	---	FRONT	VERT	SNOW	---	C1
O	25-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
S	11-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
U	3-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
W	5-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	19-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	21-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	23-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	27-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AG	29-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AH	1-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AI	5-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AJ	7-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AK	9-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AL	13-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AM	15-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AN	17-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AO	19-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AP	21-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AQ	23-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AR	27-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AS	29-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AT	31-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AU	33-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1


CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2007602 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T1Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		Version 8.310 9 Oct 29 2019 MITek Industries, Inc. Tue Apr 28 08:00:05 2020 Page 1		ID:OMCubiNVR6TsiFoe31v8t zns11-nyihMNBKcAvHCpQKtuoCRWDoscNkApnRqDRR2zMf1e	
		TRUSS DESC.			

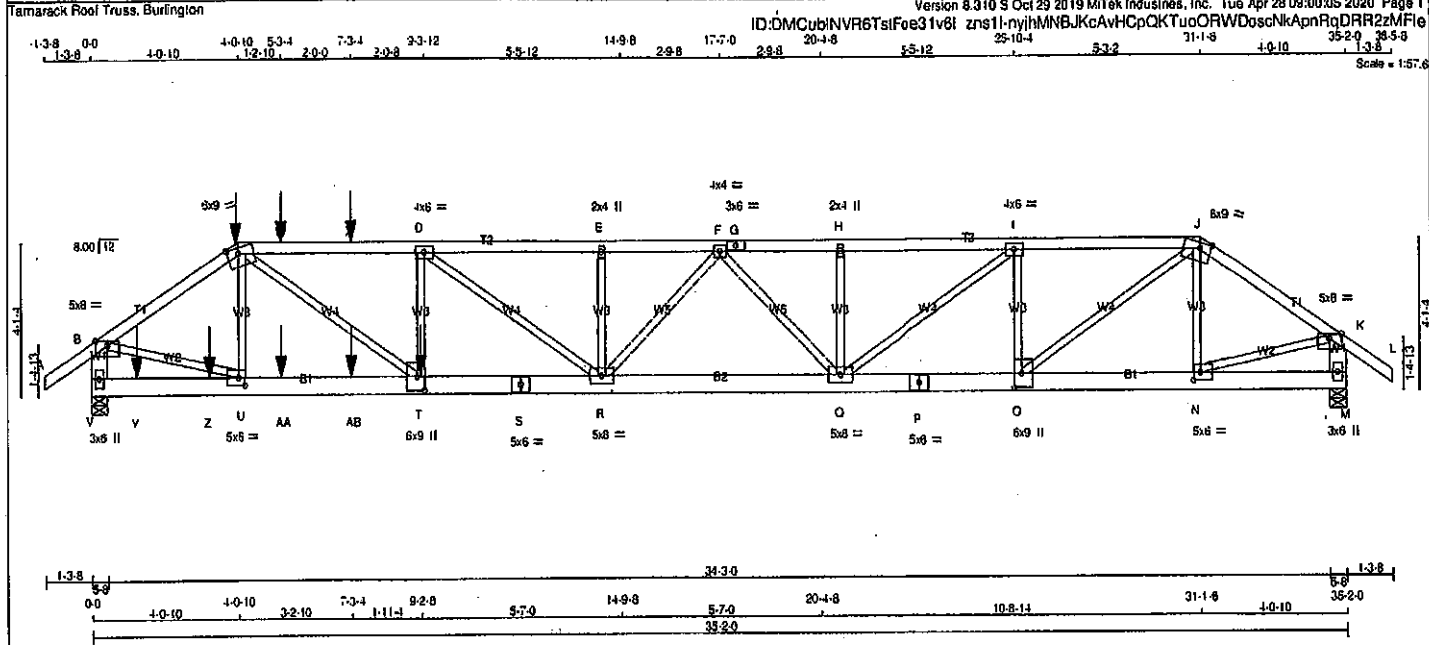

Scale = 1:57.6
TOTAL WEIGHT = 2 X 181 = 323 lb

LUMBER N. L. G. A. RULES CHORDS SIZE A - C 2x4 DRY No.2 C - G 2x4 DRY No.2 G - J 2x4 DRY No.2 J - L 2x4 DRY No.2 V - B 2x6 DRY No.2 M - K 2x6 DRY No.2 V - S 2x6 DRY No.2 S - P 2x6 DRY No.2 P - M 2x6 DRY No.2 ALL WEBS 2x3 DRY No.2 EXCEPT DRY: SEASONED LUMBER. DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS: CHORDS #ROWS SURFACE SPACING (IN) LOAD (PLF) TOP CHORDS : (0.122"x3") SPIRAL NAILS A-C 1 12 SIDE(161.0) C-G 1 12 SIDE(161.0) G-J 1 12 TOP J-L 1 12 TOP V-B 2 12 TOP M-K 2 12 TOP BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS V-S 2 12 SIDE(183.1) S-P 2 12 TOP P-M 2 12 TOP WEBS : (0.122"x3") SPIRAL NAILS 2x3 1 6 SIDE(185.4) D-T 1 4 I-O 1 4 NAILS TO BE DRIVEN FROM ONE SIDE ONLY. GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS. TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.		DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED GROSS REACTION JT VERT 4215 0 V 4215 0 M 2722 0 MAXIMUM FACTORED GROSS REACTION JT VERT 4215 0 V 4215 0 M 2722 0 INPUT BRG IN-SX 5-8 5-8 RECORD BRG IN-SX 5-8 5-8 UNFACTORED REACTIONS 1ST CASE MAX. MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM. LIVE WIND DEAD SOIL V 2974 1887 0 0 0 0 0 987 0 0 0 M 1921 1283 0 0 0 0 0 638 0 0 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.00 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS MAX. FACTORED FORCE (LBS) FACTORED VERT. LOAD (PLF) MAX. CS (LC) UNBRAC LENGTH FR-TO A-B 0 35 -91.8 -91.8 0.07 (1) 10.00 U-C -783 0 0.10 (1) B-C -5115 0 -91.8 -91.8 0.26 (1) 4.07 C-T 0 4817 0.80 (1) C-W -8135 0 -91.8 -91.8 0.64 (1) 3.00 T-D -822 0 0.08 (1) W-X -8135 0 -91.8 -91.8 0.64 (1) 3.00 O-I -1797 0 0.23 (1) X-D -8135 0 -91.8 -91.8 0.64 (1) 3.00 O-J 0 3211 0.40 (1) D-E -8108 0 -91.8 -91.8 0.59 (1) 3.05 N-J -512 0 0.06 (1) E-F -8108 0 -91.8 -91.8 0.32 (1) 3.28 B-U 0 4370 0.54 (1) F-G -6928 0 -91.8 -91.8 0.28 (1) 3.57 N-K 0 2693 0.33 (1) G-H -6928 0 -91.8 -91.8 0.26 (1) 3.57 O-I 0 2133 0.26 (1) H-I -6928 0 -91.8 -91.8 0.48 (1) 3.42 O-F -37 24 0.01 (1) I-J -5210 0 -91.8 -91.8 0.34 (1) 3.99 O-H -365 0 0.05 (1) J-K -3153 0 -91.8 -91.8 0.19 (1) 5.04 R-E -343 0 0.04 (1) K-L 0 35 -91.8 -91.8 0.07 (1) 10.00 R-F 0 692 0.08 (1) V-B -4180 0 0.0 0.0 0.15 (1) 6.99 F-Q -1081 0 0.23 (1) M-K -2698 0 0.0 0.0 0.10 (1) 7.81 V-Y 0 0 -18.5 -18.5 0.05 (4) 10.00 Y-Z 0 0 -18.5 -18.5 0.05 (4) 10.00 Z-U 0 0 -18.5 -18.5 0.05 (4) 10.00 U-AA 0 -4227 -18.5 -18.5 0.35 (1) 10.00 AA-AB 0 -4227 -18.5 -18.5 0.35 (1) 10.00 AB-T 0 -4227 -18.5 -18.5 0.35 (1) 10.00 T-S 0 8135 -18.5 -18.5 0.81 (1) 10.00 S-R 0 8135 -18.5 -18.5 0.81 (1) 10.00 R-Q 0 7645 -18.5 -18.5 0.56 (1) 10.00 Q-P 0 5210 -18.5 -18.5 0.38 (1) 10.00 P-O 0 5210 -18.5 -18.5 0.38 (1) 10.00 O-N 0 2604 -18.5 -18.5 0.19 (1) 10.00 N-M 0 0 -18.5 -18.5 0.03 (4) 10.00 FACTORED CONCENTRATED LOADS (LBS) JT LOC. LC1 MAX- MAX+ FACE DIR. TYPE HEEL CONN. C 4-0-10 -48 -55 --- FRONT VERT DEAD --- C1 C 4-0-10 -254 -254 --- FRONT VERT SNOW --- C1 T 9-2-8 -2179 -2179 --- BACK VERT TOTAL --- C1 W 5-3-4 -110 -110 --- BACK VERT TOTAL --- C1 X 7-3-4 -110 -110 --- BACK VERT TOTAL --- C1 Y 1-3-4 -26 -26 --- BACK VERT TOTAL --- C1 Z 3-3-4 -26 -26 --- BACK VERT TOTAL --- C1 AA 5-3-4 -26 -26 --- BACK VERT TOTAL --- C1 AB 7-3-4 -26 -26 --- BACK VERT TOTAL --- C1		DESIGN CRITERIA *** SPECIAL LOADS ANALYSIS *** GEOMETRY AND/OR BASIC LOADS CHANGED BY USER. LOADS WERE DERIVED FROM USER INPUT NO FURTHER MODIFICATIONS WERE MADE SPECIFIED LOADS: TOP CH. LL = 25.6 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN. OC LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12 *** NON STANDARD GIRDER *** ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES. THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF BCBC 2018, OBC 2012, ABC 2019 - PART 9 OF OBC 2012 (2019 AMENDMENT) - CSA 086-09, CSA 086-14 - TPIC 2011, TPIC 2014 (55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED RAIN LIVE LOAD ALLOWABLE DEF'L (LL) = L/360 (1.17") CALCULATED VERT. DEF'L (LL) = L/999 (0.24") ALLOWABLE DEF'L (TL) = L/360 (1.17") CALCULATED VERT. DEF'L (TL) = L/954 (0.44") CSK TC=0.64/1.00 (C-D:1), BC=0.61/1.00 (R-T:1), WB=0.60/1.00 (C-T:1), SS=0.17/1.00 (C-D:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00 COMPANION LIVE LOAD FACTOR = 1.00 AUTOSOLVE HEELS OFF TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1887 788 1987 1658 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.87 (J) INPUT = 0.90) JSI METAL= 0.77 (P) INPUT = 1.00)	
--	--	--	--	---	--

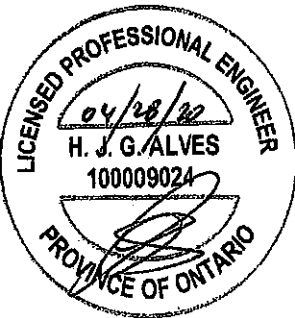

Structural component only
DWG# T-2007603

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T1Z	1	2	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 M7ek Industries, Inc. Tue Apr 28 09:00:05 2020 Page 2

ID:DMCubINVR6TstFoa31v6l zns1-l-nyjhMNB,KcAvHCpQKTuoORWDoscNkAonRqDRR2zMF1e


PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	8.0	Edge	
C TTWW-m	MT20	6.0	9.0	1.75	3.50
D TMWW-l	MT20	4.0	6.0		
E TMW+w	MT20	2.0	4.0		
F TMWW-l	MT20	4.0	4.0		
G TS-l	MT20	3.0	6.0		
H TMW+w	MT20	2.0	4.0		
I TMWW-l	MT20	4.0	6.0		
J TTWW-m	MT20	6.0	9.0	1.75	3.50
K TMVW-p	MT20	5.0	8.0	Edge	
M BMV1+p	MT20	3.0	6.0		
N BMWW-l	MT20	5.0	6.0	2.50	2.25
O BMWW+l	MT20	6.0	9.0	4.50	2.50
P BS-l	MT20	5.0	6.0		
Q BMWWW-l	MT20	5.0	8.0		
R BMWWW-l	MT20	5.0	8.0		
S BS-l	MT20	5.0	6.0		
T BMWW+l	MT20	6.0	9.0	4.50	2.50
U BMWW-l	MT20	5.0	6.0	2.50	2.25
V BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

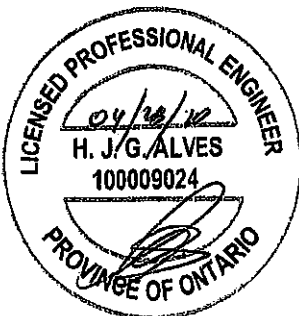


Structural component only
DWG# T-2007603 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T2	2	1	GREEN PARK HOMES	
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 2019 MITek Industries, Inc. Tue Apr 28 09:00:06 2020 Page 1
ID:DMCubINVR6TsIFoe31v6I zns11-F8H4aC5wlmvMOcuAP1x12LCGy5TgYwIUz7 UzMFId

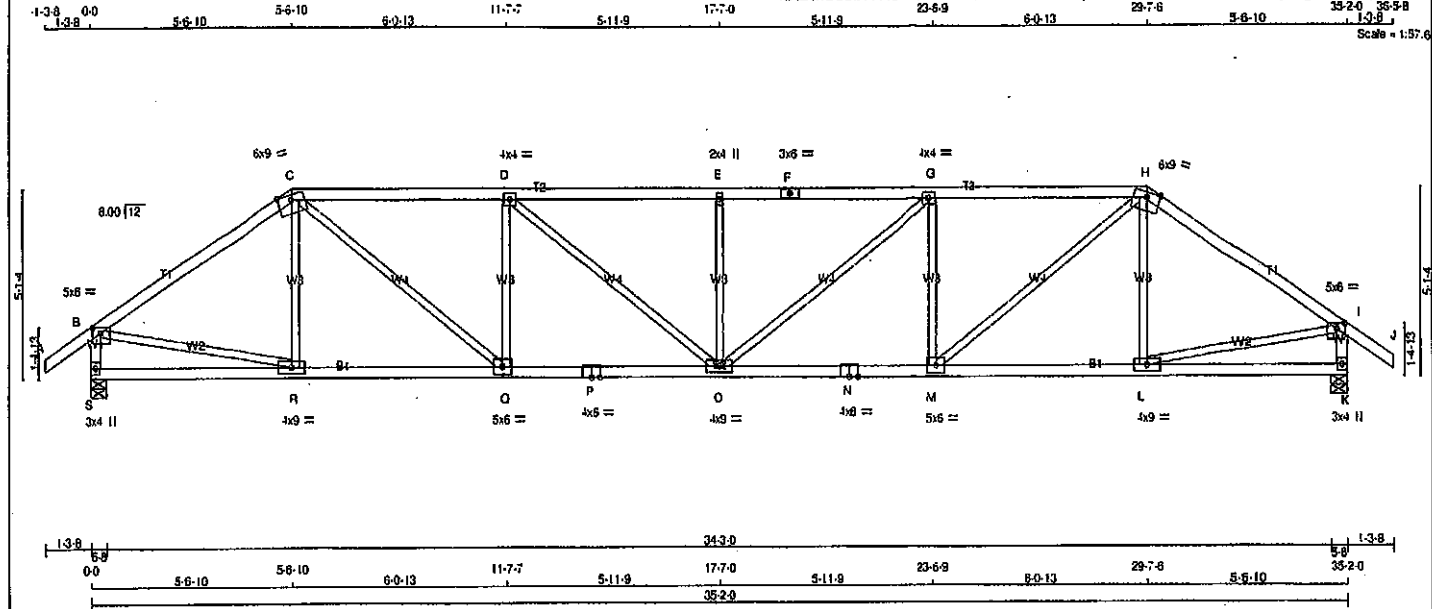

LUMBER	CHORDS	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES					
A - C	2x4	DRY	No.2	SPF	
C - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - J	2x4	DRY	No.2	SPF	
J - L	2x4	DRY	No.2	SPF	
L - N	2x4	DRY	No.2	SPF	
N - K	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
DRY: SEASONED LUMBER.					

PLATES (tablets in inches)	JT TYPE	PLATES	W	LEN	Y	X
JT	TMVW-p	MT20	5.0	8.0	1.75	2.75
C	TTWW-m	MT20	6.0	9.0	Edge	
D	TMVW-t	MT20	4.0	4.0		
E	TMVW-w	MT20	2.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMVW-t	MT20	4.0	4.0		
H	TTWW-m	MT20	6.0	9.0	Edge	
I	TMVW-p	MT20	5.0	8.0	1.75	2.75
K	BMV-t-p	MT20	3.0	4.0		
L	BMVW-t	MT20	4.0	9.0		
M	BMVW-t	MT20	5.0	6.0		
N	BS-t	MT20	4.0	6.0		
O	BMVW-w-t	MT20	4.0	9.0		
P	BS-t	MT20	4.0	6.0		
Q	BMVW-t	MT20	5.0	6.0		
R	BMVW-t	MT20	4.0	9.0		
S	BMV-t-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
		GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
S	2065	0	2065	0	0	5-8	5-8	5-8	5-8
K	2065	0	2065	0	0	5-8	5-8	5-8	5-8
UNFACTORED REACTIONS									
1ST LCASE									
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
S	1458	970.0	0.0	0.0	0.0	488.0	0.0	0.0	0.0
K	1458	970.0	0.0	0.0	0.0	488.0	0.0	0.0	0.0
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K									
BRACING									
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.97 FT.									
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.									
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.									
LOADING									
TOTAL LOAD CASES: (4)									
CHORDS									
		MAX. FACTORED		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE	VERT.	LOAD	LC1	MAX.	MEMB.	FORCE	MAX.	
(LBS)	(PLF)	CSI	(LC)	UNBRAC	(LBS)	(LBS)	CSI	(LC)	
FR-TO	FROM	TO	LENGTH	FR-TO	FROM	TO	LENGTH	FR-TO	FROM
A-B	0.35	-91.8	-91.8	0.12 (1)	10.00	R-C	-243	10	0.09 (1)
B-C	-2296	0	-91.8	-91.8	0.70 (1)	3.78	C-Q	0	1870
C-D	-3213	0	-91.8	-91.8	0.80 (1)	3.19	Q-D	-929	0
D-E	-3594	0	-91.8	-91.8	0.88 (1)	2.97	D-O	0	490
E-F	-3594	0	-91.8	-91.8	0.88 (1)	2.97	O-E	-505	0
F-G	-3594	0	-91.8	-91.8	0.88 (1)	2.97	O-G	0	490
G-H	-3213	0	-91.8	-91.8	0.80 (1)	3.19	M-G	-929	0
H-I	-2296	0	-91.8	-91.8	0.70 (1)	3.78	M-H	0	1870
I-J	0.35	-91.8	-91.8	0.12 (1)	10.00	L-H	-243	10	0.09 (1)
S-B	-2023	0	0.0	0.0	0.21 (1)	5.94	B-R	0	1943
K-I	-2023	0	0.0	0.0	0.21 (1)	5.94	L-I	0	1943
S-R	0.0	-18.5	-18.5	0.15 (4)	10.00				
R-Q	0.1903	-18.5	-18.5	0.39 (1)	10.00				
Q-P	0.3213	-18.5	-18.5	0.58 (1)	10.00				
P-O	0.3213	-18.5	-18.5	0.58 (1)	10.00				
O-N	0.3213	-18.5	-18.5	0.58 (1)	10.00				
N-M	0.3213	-18.5	-18.5	0.58 (1)	10.00				
M-L	0.1903	-18.5	-18.5	0.39 (1)	10.00				
L-K	0.0	-18.5	-18.5	0.15 (4)	10.00				

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN. C/C
LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015
THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014
ISS % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD
ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.21')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.39')
CSI: TC=0.88/1.00 (D-E:1), BC=0.58/1.00 (M-O:1), WB=0.44/1.00 (I-L:1), SS=0.28/1.00 (G-H:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10
COMPANION LIVE LOAD FACTOR = 1.00
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.
NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1987 1658
PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.87 (I) (INPUT = 0.90)
JSI METAL= 0.74 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007604


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRAWG NO.
408222	T3	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:06 2020 Page 1

ID:DMCubINVR6TstFoe31v61_zns11-F8H4aCx5WlmvMOcuAP1x2QrG_VTXHwUz7_UzMFld

1-3.8 0-0 3-7.9 3-7.9 3-5.1 7-0-10 5-3-13 12-4-7 5-2-9 17-7-0 22-9-9 5-3-13 28-1-6 3-3-1 31-8-7 35-2-0 38-5-8 1-3-8
Scale = 1:57.6

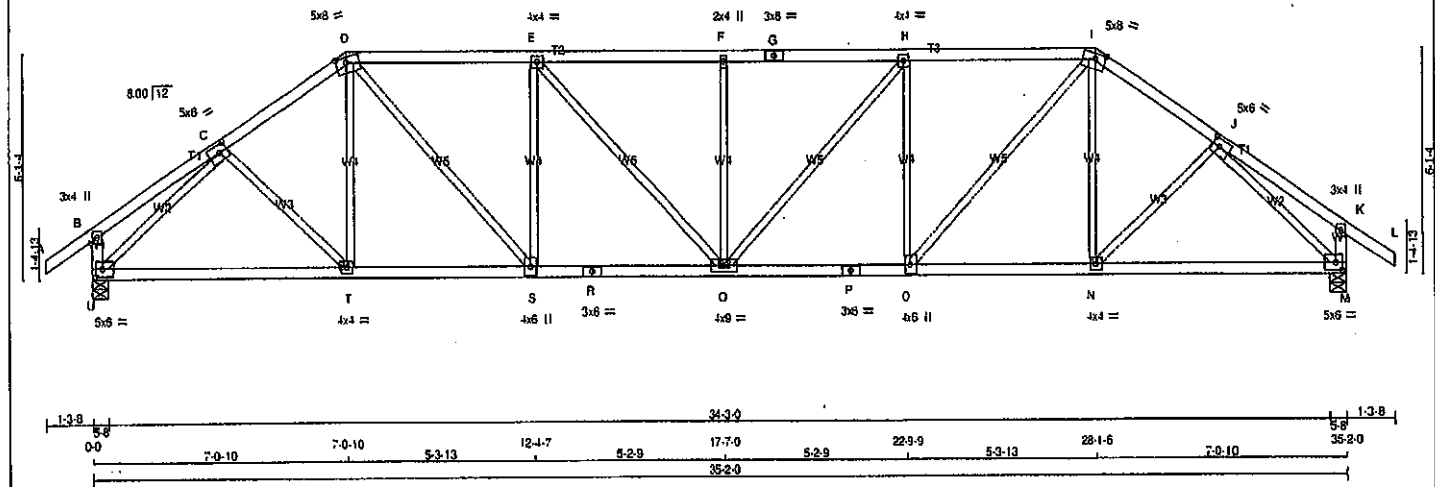

TOTAL WEIGHT = 2 X 151 - 303 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
B - G	2x4	DRY	No.2	SPF		
G - I	2x4	DRY	No.2	SPF		
I - L	2x4	DRY	No.2	SPF		
U - B	2x4	DRY	No.2	SPF		
M - K	2x4	DRY	No.2	SPF		
U - R	2x4	DRY	No.2	SPF		
R - P	2x4	DRY	No.2	SPF		
P - M	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						
DRY: SEASONED LUMBER.						

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
	FACTORED	MAXIMUM FACTORED	INPUT	RECORD					
	GROSS REACTION	GROSS REACTION	BRG	BRG					
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
U	2065	0	2065	0	0	5-8	5-8		
M	2065	0	2065	0	0	5-8	5-8		
UNFACTORED REACTIONS									
	1ST CASE	MAX. MIN.	COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
U	1458	970.0	0.0	0.0	0.0	488.0	0.0		
M	1458	970.0	0.0	0.0	0.0	488.0	0.0		
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M									
BRACING									
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.53 FT.									
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.									
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.									
LOADING									
TOTAL LOAD CASES: (4)									

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF
SPACING = 24.0 IN. C/C	
LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12	
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015	
THIS DESIGN COMPLIES WITH:	
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019	
- PART 9 OF OBC 2012 (2019 AMENDMENT)	
- CSA 088-08, CSA 088-14	
- TPIC 2011, TPIC 2014	
(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD	
ALLOWABLE DEFL. (LL) = L/360 (1.17')	
CALCULATED VERT. DEFL. (LL) = L/999 (0.16')	
ALLOWABLE DEFL. (TL) = L/360 (1.17')	
CALCULATED VERT. DEFL. (TL) = L/999 (0.29')	
CSI: TC=0.58/1.00 (E/F:1), BC=0.49/1.00 (O-Q:1), WB=0.97/1.00 (J-M:1), SS=0.23/1.00 (D-E:1)	
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10	
COMP=1.10 SHEAR=1.10 TENS=1.10	
COMPANION LIVE LOAD FACTOR = 1.00	
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.	
NAIL VALUES	
PLATE GRIP(DRY)	SHEAR SECTION
(PS)	(PL)
MAX MIN MAX MIN MAX MIN	
MT20	618 354 1867 788 1887 1656
PLATE PLACEMENT TOL. = 0.250 inches	
PLATE ROTATION TOL. = 5.0 Deg.	
JSI GRIP= 0.90 (M) (INPUT = 0.90)	
JSI METAL= 0.84 (P) (INPUT = 1.00)	

PLATES (table in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	5.0	6.0	2.50	2.50
D	TTWW-m	MT20	5.0	8.0	1.75	3.50
E	TMWW-t	MT20	4.0	4.0		
F	TMW+w	MT20	2.0	4.0		
G	TS-t	MT20	3.0	6.0		
H	TMWW-t	MT20	4.0	4.0		
I	TTWW-m	MT20	5.0	8.0	1.75	3.50
J	TMWW-t	MT20	5.0	6.0	2.50	2.50
K	TMV+p	MT20	3.0	4.0		
M	BMVW-t	MT20	5.0	6.0	2.50	2.25
N	BMVW-t	MT20	4.0	4.0		
O	BMVW-t	MT20	4.0	6.0		
P	BS-t	MT20	3.0	6.0		
Q	BMVW-t	MT20	4.0	9.0		
R	BS-t	MT20	3.0	6.0		
S	BMVW-t	MT20	4.0	6.0		
T	BMVW-t	MT20	4.0	4.0		
U	BMVW-t	MT20	5.0	6.0	2.50	2.25

CHORDS									
MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED	MAX
	FORCE	(PLF)			CS1 (LC)	UNBRAC		FORCE	CS1 (LC)
FR-TO		FROM TO				LENGTH	FR-TO		
A-B	0.35	-91.8	-91.8	0.12 (1)	10.00		C-T	0.135	0.03 (4)
B-C	0.18	-91.8	-91.8	0.18 (1)	10.00		T-D	0.80	0.03 (4)
C-D	-2305	0	-91.8	-91.8	0.23 (1)	4.31	D-S	0.1218	0.27 (1)
D-E	-2723	0	-91.8	-91.8	0.54 (1)	3.69	S-E	-814	0.48 (1)
E-F	-2886	0	-91.8	-91.8	0.56 (1)	3.53	E-Q	0.363	0.08 (1)
F-G	-2886	0	-91.8	-91.8	0.58 (1)	3.53	Q-F	-440	0.28 (1)
G-H	-2886	0	-91.8	-91.8	0.58 (1)	3.53	Q-H	0.383	0.08 (1)
H-I	-2723	0	-91.8	-91.8	0.54 (1)	3.69	H-I	-814	0.48 (1)
I-J	-2305	0	-91.8	-91.8	0.23 (1)	4.31	O-I	0.1218	0.27 (1)
J-K	0.18	-91.8	-91.8	0.18 (1)	10.00		N-I	0.90	0.03 (4)
K-L	0.35	-91.8	-91.8	0.12 (1)	10.00		N-J	0.135	0.03 (4)
U-B	-255	0	0.0	0.0	0.03 (1)	7.81	U-C	-2514	0.97 (1)
M-K	-255	0	0.0	0.0	0.03 (1)	7.81	J-M	-2514	0.97 (1)
U-T	0.1801	-18.5	-18.5	0.40 (1)	10.00				
T-S	0.1800	-18.5	-18.5	0.41 (1)	10.00				
S-R	0.2723	-18.5	-18.5	0.49 (1)	10.00				
R-Q	0.2723	-18.5	-18.5	0.49 (1)	10.00				
Q-P	0.2723	-18.5	-18.5	0.49 (1)	10.00				
P-O	0.2723	-18.5	-18.5	0.49 (1)	10.00				
O-N	0.1900	-18.5	-18.5	0.41 (1)	10.00				
N-M	0.1801	-18.5	-18.5	0.40 (1)	10.00				




Structural component only
DWG# T-2007605

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T4	2	1	TRUSS DESC.		

Tanarack Roof Truss, Burlington

Version 8.310 5 Oct 2019 MTEK Industries, Inc. Tue Apr 28 09:00:07 2020 Page 1

ID:DMCubINVR6TstFoe31v6l_zns1l-lrSn2CZsDQdXWzpSuwGTsbZlqK2C5T4u8fYwWzMFic

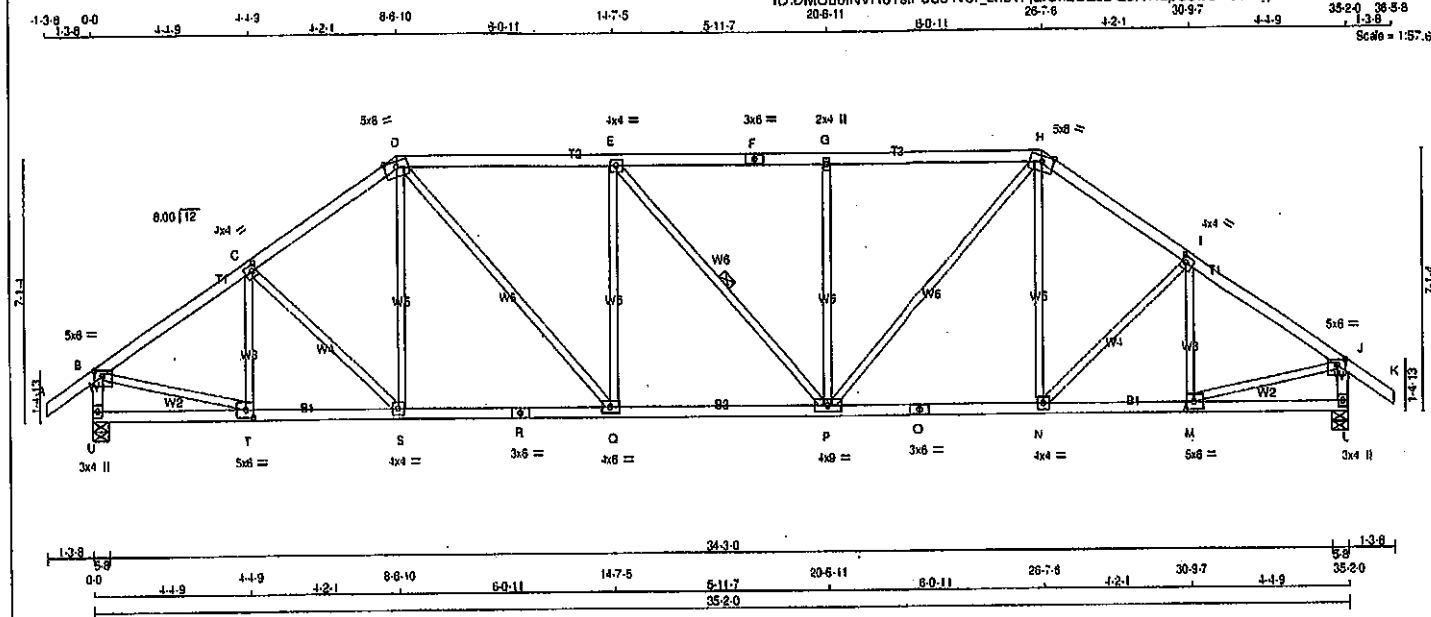

TOTAL WEIGHT = 2 X 155 = 309 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
E - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - K	2x4	DRY	No.2	SPF	
U - B	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
U - R	2x4	DRY	No.2	SPF	
R - O	2x4	DRY	No.2	SPF	
O - L	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
DRY: SEASONED LUMBER.					

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING DESIGNER								
BEARINGS								
FACTORED			MAXIMUM FACTORED			INPUT	RECORD	
GROSS REACTION			GROSS REACTION			BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
U	2065	0	2065	0	0	5-8	5-8	
L	2065	0	2065	0	0	5-8	5-8	

UNFACTORED REACTIONS		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
U	1458	970 0	0 0	0 0	0 0	488 0	0 0
L	1458	970 0	0 0	0 0	0 0	488 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1.2 LENGTH OF E-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING		TOTAL LOAD CASES: (4)	
CHORDS	WEBS	FACTORED	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. FORCE (LBS)
FR-TO	FROM TO	FROM TO	FROM TO
A-B	0 35	-81.8 -91.8 0.12 (1)	10.00
B-C	-2289 0	-91.8 -91.8 0.37 (1)	4.19
C-D	-2254 0	-91.8 -91.8 0.36 (1)	4.21
D-E	-2485 0	-91.8 -91.8 0.84 (1)	3.72
E-F	-2483 0	-91.8 -91.8 0.84 (1)	3.72
F-G	-2483 0	-91.8 -91.8 0.84 (1)	3.72
G-H	-2483 0	-91.8 -91.8 0.83 (1)	3.74
H-I	-2254 0	-91.8 -91.8 0.36 (1)	4.21
I-J	-2269 0	-91.8 -91.8 0.37 (1)	4.19
J-K	0 35	-91.8 -91.8 0.12 (1)	10.00
U-B	-2027 0	0.0 0.0 0.21 (1)	5.84
L-J	-2026 0	0.0 0.0 0.21 (1)	5.94
U-T	0 0	-18.5 -18.5 0.08 (4)	10.00
T-S	0 1908	-18.5 -18.5 0.37 (1)	10.00
S-R	0 1853	-18.5 -18.5 0.36 (1)	10.00
R-Q	0 1853	-18.5 -18.5 0.36 (1)	10.00
Q-P	0 2485	-18.5 -18.5 0.47 (1)	10.00
P-O	0 1854	-18.5 -18.5 0.36 (1)	10.00
O-N	0 1854	-18.5 -18.5 0.36 (1)	10.00
N-M	0 1908	-18.5 -18.5 0.37 (1)	10.00
M-L	0 0	-18.5 -18.5 0.08 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17')
CALCULATED VERT. DEFL. (LL) = L/989 (0.12')
ALLOWABLE DEFL. (TL) = L/360 (1.17')
CALCULATED VERT. DEFL. (TL) = L/999 (0.24')

CSI: TC=0.84/1.00 (D-E:1), BC=0.47/1.00 (P-Q:1), WB=0.52/1.00 (E-Q:1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1887 788 1987 1858


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (D) (INPUT = 0.90)
JSI METAL= 0.82 (D) (INPUT = 1.00)




Structural component only
DWG# T-2007606

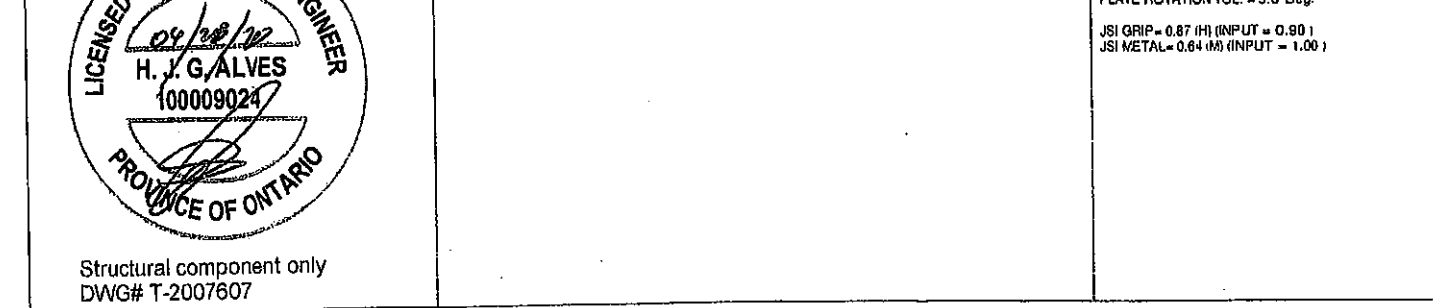

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T6	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	


Version 8.310 S Oct 29 2019 M&T Industries, Inc. Tue Apr 28 09:00:09 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-fjyCCkEpOrgLmp6BZlykZHqkU0ng01MLSBfapzMFia
35-2-0 35-5-8 1-3-8
Scale = 1/8" = 1'-0"

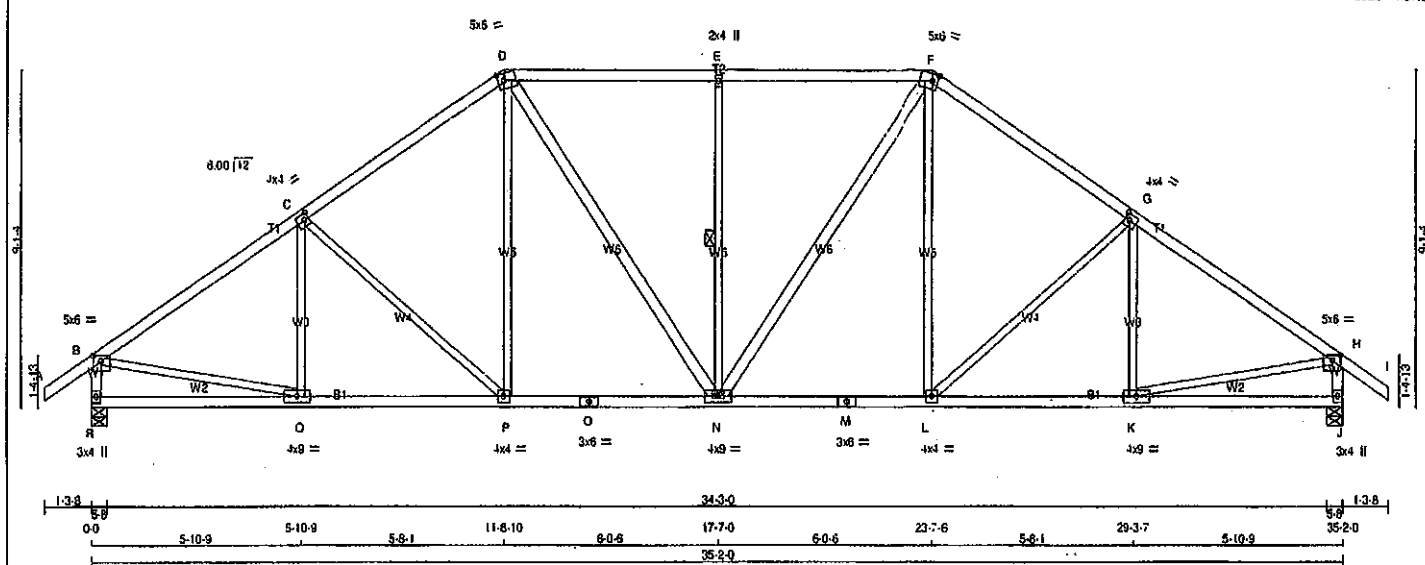

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT TYPE	PLATES	W.	LEN	Y X
B	TMWV-p	MT20	5.0	8.0 1.75 2.75
C	TMWV-i	MT20	4.0	4.0 2.00 1.50
D	TTWV-m	MT20	5.0	6.0 2.25 2.00
E	TMWV-w	MT20	2.0	4.0
F	TTWV-m	MT20	5.0	6.0 2.25 2.00
G	TMWV-i	MT20	4.0	4.0 2.00 1.50
H	TMWV-p	MT20	5.0	6.0 1.75 2.75
J	BMV1-p	MT20	3.0	4.0
K	BMWV-i	MT20	4.0	9.0
L	BMWV-i	MT20	4.0	4.0
M	BS-1	MT20	3.0	6.0
N	BMWVW-i	MT20	4.0	9.0
O	BS-1	MT20	3.0	6.0
P	BMWV-i	MT20	4.0	4.0
Q	BMWV-i	MT20	4.0	9.0
R	BMV1-p	MT20	3.0	4.0

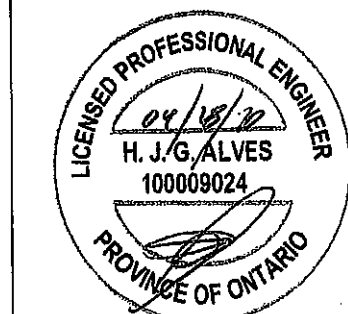

Structural component only
DWG# T-2007608

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
R	2065	0	2065	0	5-8
J	2065	0	2065	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1458	970	0	0:0	0:0	0	488	0
J	1458	970	0	0:0	0:0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS						WEBS				
MAX. FACTORED		FACTORED				MAX. FACTORED				
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 (PLF)	MAX CS1 (LC)	UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX CS1 (LC)		
FR-TO		FROM	TO			FR-TO				
A-B	0:35	-91.8	-91.8	0.12 (1)	10.00	Q-C	-249 11	0.11 (1)		
B-C	-2346 0	-91.8	-91.8	0.52 (1)	3.99	C-P	-356 0	0.42 (1)		
C-D	-2095 0	-91.8	-91.8	0.48 (1)	4.22	P-D	0 341	0.08 (1)		
D-E	-1985 0	-91.8	-91.8	0.49 (1)	4.26	D-N	0 477	0.08 (1)		
E-F	-1985 0	-91.8	-91.8	0.49 (1)	4.26	N-E	-678 0	0.37 (1)		
F-G	-2095 0	-91.8	-91.8	0.48 (1)	4.22	N-F	0 477	0.08 (1)		
G-H	-2346 0	-91.8	-91.8	0.52 (1)	3.99	L-F	0 341	0.08 (1)		
H-I	0:35	-91.8	-91.8	0.12 (1)	10.00	L-G	-356 0	0.42 (1)		
R-B	-2018 0	0.0	0.0	0.21 (1)	5.94	K-G	-249 11	0.11 (1)		
J-H	-2018 0	0.0	0.0	0.21 (1)	5.94	B-Q	0 2014	0.48 (1)		
						K-H	0 2014	0.45 (1)		
R-Q	0 0	-18.5	-18.5	0.14 (4)	10.00					
Q-P	0 1980	-18.5	-18.5	0.39 (1)	10.00					
P-O	0 1718	-18.5	-18.5	0.34 (1)	10.00					
O-N	0 1718	-18.5	-18.5	0.34 (1)	10.00					
N-M	0 1718	-18.5	-18.5	0.34 (1)	10.00					
M-L	0 1718	-18.5	-18.5	0.34 (1)	10.00					
L-K	0 1981	-18.5	-18.5	0.39 (1)	10.00					
K-J	0 0	-18.5	-18.5	0.14 (4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF NBC 2010 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 26.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/989 (0.19")

CS1: TC=0.52/1.00 (G-H:1), SC=0.39/1.00 (K-L:1), WB=0.45/1.00 (H-K:1), SS=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1655

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.87 (H) INPUT = 0.90
JSI METAL = 0.56 (M) INPUT = 1.00

JOB NAME 408222	TRUSS NAME T7	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:00:10 2020 Page 1

ID:DMCubINVR6TslFos31v6l_zns11-7wWaP4FR98oCOzh070Uz5VD4qtMXPTGwa8xC7FzMFIZ

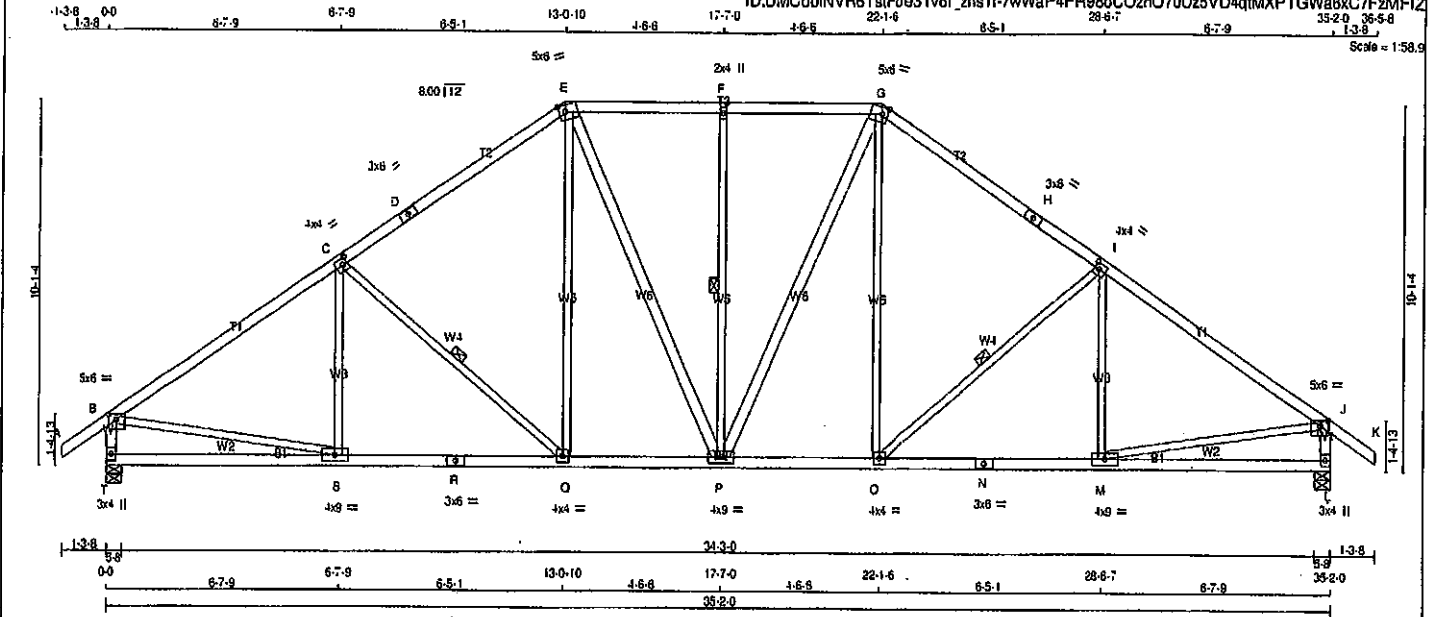

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - J	2x4	DRY	No.2
J - R	2x4	DRY	No.2
R - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
E - P	2x4	DRY	No.2
P - G	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW-p	MT20	5.0	6.0 1.75 2.75
C	TMWW-l	MT20	4.0	4.0 2.00 1.50
D	TS-l	MT20	3.0	6.0
E	TTWW-m	MT20	5.0	6.0 2.25 2.00
F	TMW-w	MT20	2.0	4.0
G	TTWW-m	MT20	5.0	6.0 2.25 2.00
H	TS-l	MT20	3.0	6.0
I	TMWW-l	MT20	4.0	4.0 2.00 1.50
J	TMVW-p	MT20	5.0	6.0 1.75 2.75
L	BMV-l-p	MT20	3.0	4.0
M	BMWW-l	MT20	4.0	9.0
N	BS-l	MT20	3.0	6.0
O	BMWW-l	MT20	4.0	4.0
P	BMWW-l	MT20	4.0	9.0
Q	BMWW-l	MT20	4.0	4.0
R	BS-l	MT20	3.0	6.0
S	BMWW-l	MT20	4.0	9.0
T	BMV-l-p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
	FACTORED	MAXIMUM FACTORED	INPUT REQD
	GROSS REACTION	GROSS REACTION	BRG BRG
JT	VERT	DOWN	HORIZ UPLIFT IN-SX IN-SX
T	2065	0	0 5-8 5-8
L	2065	0	0 5-8 5-8

UNFACTORED REACTIONS			
	1ST LOOSE	MAX-MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE PERM-LIVE WIND DEAD SOIL
T	1458	970	0 0 0 0 488 0 0 0
L	1458	970	0 0 0 0 0 0 488 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1:2 LENGTH OF C-Q, F-P, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. MAX. CS1(LC) UNBRAC LENGTH
FR-TO			
A-B	0 35	-91.8 -91.8 0.12 (1)	10.00
B-C	-2358 0	-91.8 -91.8 0.89 (1)	3.77
C-D	-1996 0	-91.8 -91.8 0.82 (1)	4.11
D-E	-1996 0	-91.8 -91.8 0.82 (1)	4.11
E-F	-1761 0	-91.8 -91.8 0.27 (1)	4.77
F-G	-1761 0	-91.8 -91.8 0.27 (1)	4.77
G-H	-1996 0	-91.8 -91.8 0.82 (1)	4.11
H-I	-1996 0	-91.8 -91.8 0.82 (1)	4.11
I-J	-2358 0	-91.8 -91.8 0.89 (1)	3.77
J-K	0 35	-91.8 -91.8 0.12 (1)	10.00
K-L	-2014 0	0.0 0.0 0.21 (1)	5.95
L-J	-2014 0	0.0 0.0 0.21 (1)	5.95
T-S	0 0	-18.5 -18.5 0.19 (4)	10.00
S-R	0 1995	-18.5 -18.5 0.42 (1)	10.00
R-Q	0 1995	-18.5 -18.5 0.42 (1)	10.00
Q-P	0 1629	-18.5 -18.5 0.32 (1)	10.00
P-O	0 1629	-18.5 -18.5 0.32 (1)	10.00
O-N	0 1995	-18.5 -18.5 0.42 (1)	10.00
N-M	0 1995	-18.5 -18.5 0.42 (1)	10.00
M-L	0 0	-18.5 -18.5 0.19 (4)	10.00

TOTAL WEIGHT = 8 X 172 = 1030 lb

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF
SPACING	= 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2010, CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.16")

CSI: TC=0.69/1.00 (I-J:1), BC=0.42/1.00 (M-O:1), WB=0.45/1.00 (J-K:1), SS=0.24/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1887 788	1887 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (I) (INPUT = 0.90)
JSI METAL = 0.87 (I) (INPUT = 1.00)




Structural component only
DWG# T-2007609

JOB NAME 408222	TRUSS NAME T8	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:00:10 2020 Page 1

ID:DMCubINVR6TstF0e31v61, 2ns11-7wW4P4FR98oCOz0U25VD1gIM2PTGWA6xC7FzMFIZ

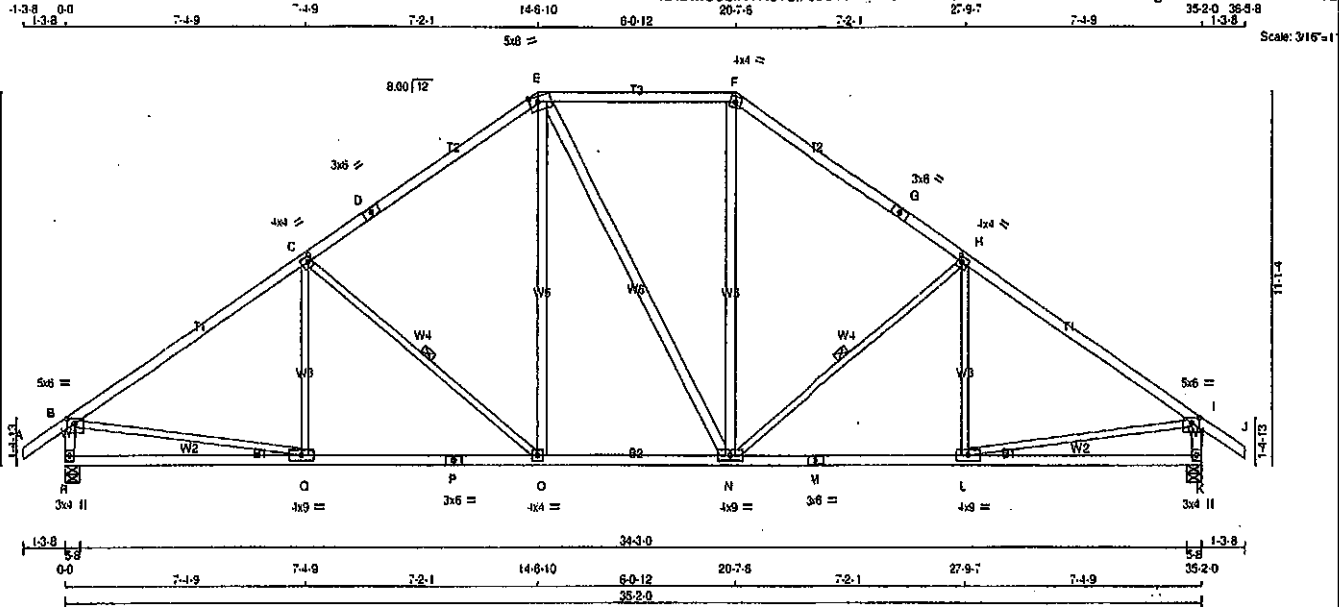

TOTAL WEIGHT = 2 X 166 = 332 lb (M/F)

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - J	2x4	DRY	No.2
J - B	2x4	DRY	No.2
K - I	2x4	DRY	No.2
K - P	2x4	DRY	No.2
P - M	2x4	DRY	No.2
M - K	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
O - E	2x4	DRY	No.2
E - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	2.75
C	TMVW-l	MT20	4.0	4.0	2.00	1.50
D	TS-l	MT20	3.0	6.0		
E	TTW-m	MT20	5.0	8.0	2.00	3.00
F	TTW-m	MT20	4.0	4.0		
G	TS-l	MT20	3.0	6.0		
H	TMVW-l	MT20	4.0	4.0	2.00	1.50
I	TMVW-p	MT20	5.0	6.0	1.75	2.75
K	BMV1-p	MT20	3.0	4.0		
L	BMVW-l	MT20	4.0	9.0		
M	BS-l	MT20	3.0	6.0		
N	BMVW-l	MT20	4.0	9.0		
O	BMVW-l	MT20	4.0	4.0		
P	BS-l	MT20	3.0	6.0		
Q	BMVW-l	MT20	4.0	9.0		
R	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED	GROSS REACTION	MAXIMUM FACTORED	GROSS REACTION	INPUT	RECORD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
R	2065	0	2065	0	5-8	5-8	
K	2065	0	2065	0	5-8	5-8	

UNFACTORED REACTIONS							
JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
R	1458	970.0	0.0	0.0	0.0	488.0	0.0
K	1458	970.0	0.0	0.0	0.0	488.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.45 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-O, H-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSH (LC)	
FR-TO				FR-TO			
A-B	0 35	-91.8	-91.8 0.12 (1)	10.00	C-C	-140 76	0.09 (1)
B-C	-2357 0	-91.8	-91.8 0.89 (1)	3.45	C-O	-604 0	0.38 (1)
C-D	-1688 0	-91.8	-91.8 0.78 (1)	3.91	O-E	0 499	0.08 (1)
D-E	-1688 0	-91.8	-91.8 0.78 (1)	3.91	E-N	0 0	0.00 (1)
E-F	-1538 0	-91.8	-91.8 0.47 (1)	4.74	N-F	0 500	0.08 (1)
F-G	-1688 0	-91.8	-91.8 0.78 (1)	3.91	N-H	-604 0	0.38 (1)
G-H	-1688 0	-91.8	-91.8 0.78 (1)	3.91	L-H	-140 75	0.09 (1)
H-I	-2357 0	-91.8	-91.8 0.89 (1)	3.45	B-O	0 2020	0.45 (1)
I-J	0 35	-91.8	-91.8 0.12 (1)	10.00	L-I	0 2019	0.45 (1)
R-B	-2009 0	0.0	0.0 0.21 (1)	5.95			
K-I	-2009 0	0.0	0.0 0.21 (1)	5.95			
R-Q	0 0	-18.5	-18.5 0.25 (4)	10.00			
Q-P	0 1998	-18.5	-18.5 0.45 (1)	10.00			
P-O	0 1998	-18.5	-18.5 0.45 (1)	10.00			
O-N	0 1538	-18.5	-18.5 0.33 (1)	10.00			
N-M	0 1998	-18.5	-18.5 0.45 (1)	10.00			
M-L	0 1998	-18.5	-18.5 0.45 (1)	10.00			
L-K	0 0	-18.5	-18.5 0.24 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.09')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.20')

CSI: TC=0.89/1.00 (B-C:1), 80=0.45/1.00 (O-Q:1), WB=0.45/1.00 (B-Q:1), SS=0.27/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (F) (INPUT = 0.90)
JSI METAL= 0.68 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007610


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T9	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 3 Oct 2019 MITek Industries, Inc. Tue Apr 28 09:00:11 2020 Page 1

ID:DMCubINVR6TstFoe31v6l_zns1t-b64ydQG4wSx377Gahi?CeimKBHhBBztfmgmizMFIY

1-3.8 0-0 3-9.8 3-9.8 3-7.0 7-4.8 1-10.12 12-3.4 1-9.8 1-10.12 21-11.8 3-10.8 25-10.0 1-3.8 27-1.8
Scale = 1:12

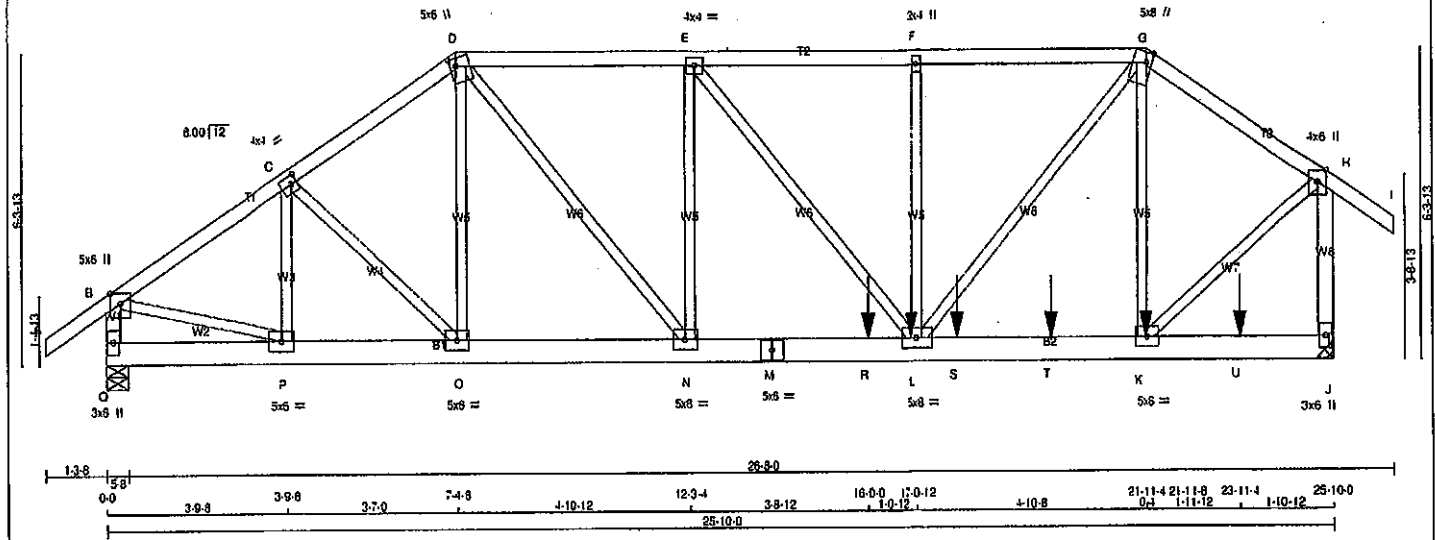

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - G	2x4	DRY	No.2	SPF		
G - I	2x4	DRY	No.2	SPF		
Q - B	2x4	DRY	No.2	SPF		
J - H	2x4	DRY	No.2	SPF		
Q - M	2x6	DRY	No.2	SPF		
M - J	2x6	DRY	No.2	SPF		

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122'X3") SPIRAL NAILS		
A - D 1 12	TOP	
D - G 1 12	TOP	
G - I 1 12	TOP	
Q - B 1 12	TOP	
J - H 1 12	TOP	
BOTTOM CHORDS : (0.122'X3") SPIRAL NAILS		
Q - M 2 12	TOP	
M - J 2 12	SIDE (183.1)	
WEBS : (0.122'X3") SPIRAL NAILS		
2x3 1 6		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORIZ	UPLIFT	IN-SX
Q	2236 0	2236 0	0 0	5-8 5-8
J	3067 0	3067 0	0 0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 4-0.

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW
Q	1576 1065 0	0 0
J	2157 1479 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.97 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LCI (PLF)	MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 35	-91.8 -91.8	0.07 (1)	10.00	P-C	-503 0	0.08 (1)
B-C	-2484 0	-91.8 -91.8	0.13 (1)	5.62	C-D	0 70	0.01 (1)
C-D	-2571 0	-91.8 -91.8	0.13 (1)	5.63	D-E	-2 60	0.01 (4)
D-E	-3030 0	-91.8 -91.8	0.20 (1)	5.11	E-F	0 1433	0.18 (1)
E-F	-3235 0	-91.8 -91.8	0.21 (1)	4.97	F-G	-736 0	0.22 (1)
F-G	-3235 0	-91.8 -91.8	0.20 (1)	4.99	G-H	0 327	0.04 (1)
G-H	-2123 0	-91.8 -91.8	0.15 (1)	5.91	H-I	-169 0	0.14 (1)
H-I	0 35	-91.8 -91.8	0.07 (1)	10.00	I-J	0 2339	0.29 (1)
I-J	-2188 0	0.0 0.0	0.12 (1)	7.53	J-K	-995 0	0.30 (1)
J-K	-2962 0	0.0 0.0	0.33 (1)	6.70	K-H	0 2299	0.28 (1)
Q-P	0 0	-18.5 -18.5	0.02 (1)	10.00			
P-O	0 2067	-18.5 -18.5	0.16 (1)	10.00			
O-N	0 2118	-18.5 -18.5	0.22 (1)	10.00			
N-M	0 3030	-18.5 -18.5	0.45 (1)	10.00			
M-R	0 3030	-18.5 -18.5	0.45 (1)	10.00			
R-L	0 3030	-18.5 -18.5	0.45 (1)	10.00			
L-S	0 1748	-18.5 -18.5	0.27 (1)	10.00			
S-T	0 1748	-18.5 -18.5	0.27 (1)	10.00			
T-K	0 1748	-18.5 -18.5	0.27 (1)	10.00			
K-U	0 0	-18.5 -18.5	0.06 (1)	10.00			
U-J	0 0	-18.5 -18.5	0.06 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
K	21-11-4	-187	-187	---	FRONT	VERT	TOTAL	---	C1
L	16-11-4	-187	-187	---	FRONT	VERT	TOTAL	---	C1
R	16-0-0	-1259	-1259	---	FRONT	VERT	TOTAL	---	C1
S	17-11-4	-187	-187	---	FRONT	VERT	TOTAL	---	C1
T	19-11-4	-187	-187	---	FRONT	VERT	TOTAL	---	C1
U	23-11-4	-195	-195	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN PLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.88")
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
ALLOWABLE DEFL.(TL) = L/360 (0.88")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CS1: TC=0.33/1.00 (H-J:1), SC=0.45/1.00 (L-N:1), WB=0.30/1.00 (G-K:1), SS1=0.35/1.00 (L-N:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1556

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.81 (H) (INPUT = 0.90)
JSI METAL = 0.53 (H) (INPUT = 1.00)



Structural component only
DWG# T-2007611 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T9	1	2	GREEN PARK HOMES	
TAMARACK ROOF TRUSS, BURLINGTON				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:11 2020 Page 2

ID:DMCubINVR6TslFoe31v6L_zns1L-b64vdQG4wSx377Gahi?CeimKBHhB8ziPmnmfzMFly

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMW+p	MT20	5.0	6.0	Edge	
C	TMW+l	MT20	4.0	4.0	2.00	1.50
D	TTWW+m	MT20	5.0	6.0	2.00	1.50
E	TMW+l	MT20	4.0	4.0		
F	TMW+w	MT20	2.0	4.0		
G	TTWW+m	MT20	5.0	8.0	2.50	1.50
H	TMW+p	MT20	4.0	6.0	Edge	
J	BMV1+p	MT20	3.0	6.0		
K, N, O, P						
K	BMW+l	MT20	5.0	6.0		
L	BMWW+l	MT20	5.0	8.0		
M	BS+l	MT20	5.0	6.0		
Q	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.




Structural component only
DWG# T-2007611

JOB NAME 408222	TRUSS NAME T10	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:00:12 2020 Page 1

ID:DMCubINVR6TsFoe31v6l_zns1f4leLqmGihm3wdHrmERWRAwUKM4GILp2QQJB8zMFIX

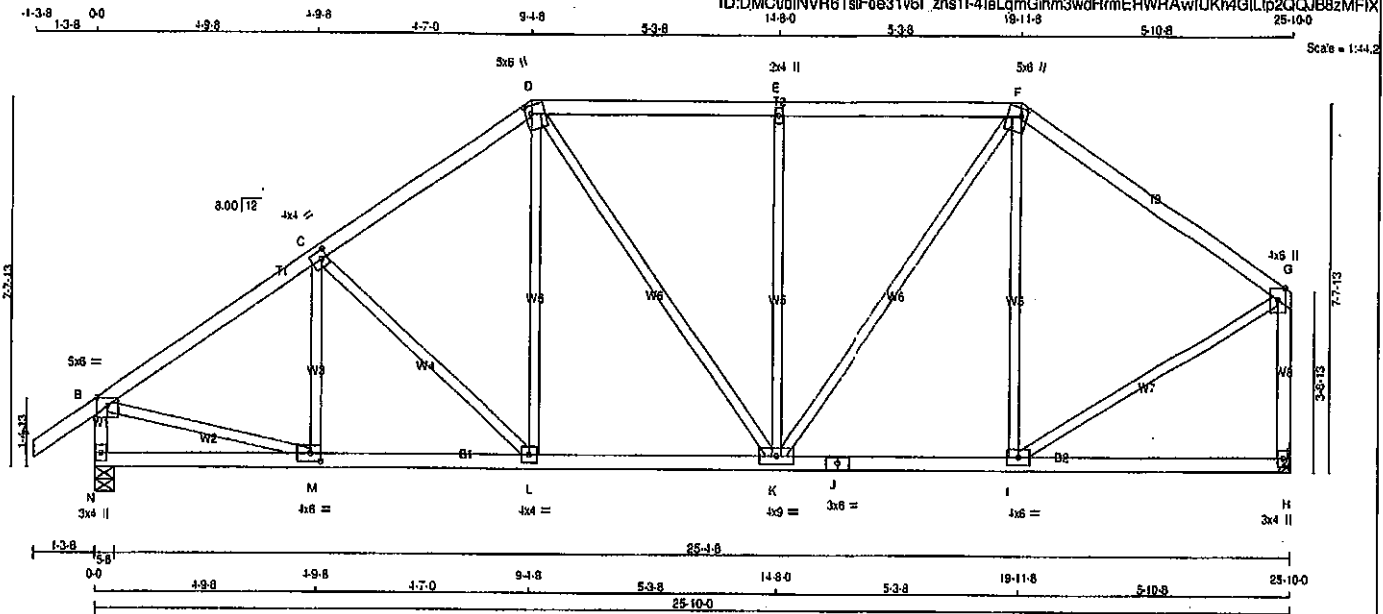

TOTAL WEIGHT = 118 lb (M/F)

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - G	2x4	DRY No.2	SPF
N - B	2x4	DRY No.2	SPF
H - G	2x4	DRY No.2	SPF
N - J	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMWV-p	MT20	5.0	6.0	Edge
C	TMWV-w	MT20	4.0	4.0	2.00 1.50
D	TTWW-m	MT20	5.0	6.0	2.00 1.50
E	TMWV-w	MT20	2.0	4.0	
F	TTWW-m	MT20	5.0	6.0	2.00 1.50
G	TMWV-p	MT20	4.0	6.0	Edge
H	BMV1-p	MT20	3.0	4.0	
I	BMWV-w	MT20	4.0	6.0	
J	BS-1	MT20	3.0	6.0	
K	BMWV-w	MT20	4.0	6.0	
L	BMWV-w	MT20	4.0	4.0	
M	BMWV-w	MT20	4.0	6.0	2.00 2.50
N	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	REQD BRG IN-SX
JT	VERT	HORZ	DOWN	HORZ
N	1550	0	1550	0
H	1424	0	1424	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3'-8\"

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
N	1094	731	0	0	0	383	0
H	1007	661	0	0	0	348	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.93 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO				FR-TO			
A-B	0 35	-91.8	-91.8 0.12 (1)	10.00	M-C	-217 3	0.07 (1)
B-C	-1609 0	-91.8	-91.8 0.29 (1)	4.93	C-L	-273 0	0.20 (1)
C-D	-1425 0	-91.8	-91.8 0.28 (1)	5.17	L-D	0 280	0.06 (1)
D-E	-1272 0	-91.8	-91.8 0.35 (1)	5.30	D-K	0 185	0.04 (1)
E-F	-1272 0	-91.8	-91.8 0.35 (1)	5.30	K-E	-595 0	0.64 (1)
F-G	-1077 0	-91.8	-91.8 0.43 (1)	5.52	K-F	0 655	0.15 (1)
N-B	-1511 0	0.0	0.0 0.16 (1)	6.68	I-F	-390 0	0.42 (1)
H-G	-1380 0	0.0	0.0 0.32 (1)	6.92	B-M	0 1386	0.31 (1)
					I-G	0 1031	0.23 (1)
N-M	0 0	-18.5	-18.5 0.09 (4)	10.00			
M-L	0 1362	-18.5	-18.5 0.27 (1)	10.00			
L-K	0 1164	-18.5	-18.5 0.24 (1)	10.00			
K-J	0 890	-18.5	-18.5 0.23 (1)	10.00			
J-I	0 890	-18.5	-18.5 0.23 (1)	10.00			
I-H	0 0	-18.5	-18.5 0.15 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9. NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

165 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.86")
CALCULATED VERT. DEFL. (LL) = L/998 (0.05")
ALLOWABLE DEFL. (TL) = L/360 (0.86")
CALCULATED VERT. DEFL. (TL) = L/999 (0.08")

CSI: TC=0.43/1.00 (F-G:1), BC=0.27/1.00 (L-M:1),
WB=0.64/1.00 (E-K:1), SG=0.23/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 L5 BEND=1 10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (B) INPUT = 0.80
JSI METAL = 0.56 (G) INPUT = 1.00

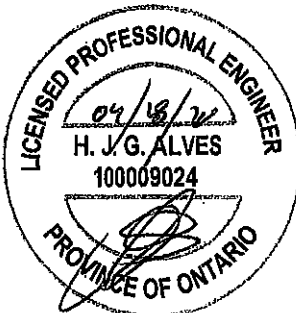


Structural component only
DWG# T-2007612.

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T11A	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:00:12 2020 Page 1

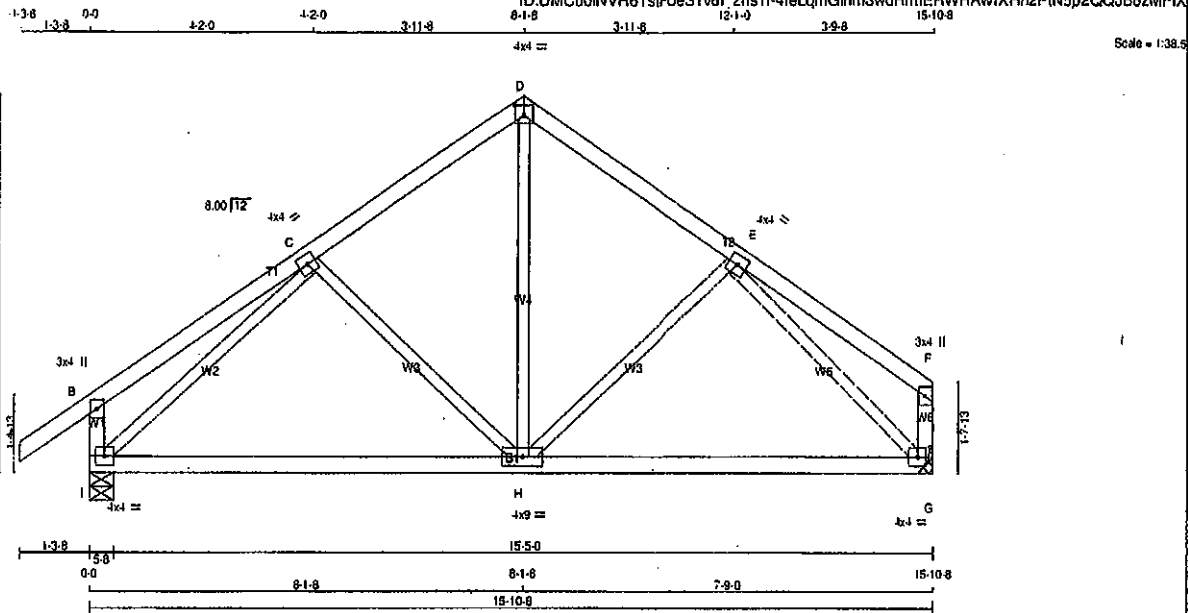

TOTAL WEIGHT = 2 X 68 = 136 lb (M/F)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - F	2x4	DRY	No.2	SPF		
I - B	2x4	DRY	No.2	SPF		
G - F	2x4	DRY	No.2	SPF		
I - G	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+P	MT20	3.0	4.0		
C	TMVW-I	MT20	4.0	4.0		
D	TTW-P	MT20	4.0	4.0	2.25	2.00
E	TMVW-I	MT20	4.0	4.0		
F	TMV+P	MT20	3.0	4.0		
G	BMVW-I	MT20	4.0	4.0		
H	BMVW-I	MT20	4.0	9.0		
I	BMVW-I	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORIZ	DOWN	HORIZ
I	1001	0	1001	0
G	875	0	875	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
I	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
G	706	476	0	0	0	0
G	819	406	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED	FORCE	VERT.	FACTORED	LOAD	LC1	MAX	CS1	LC2	UNBRAC	LENGTH	FR-TO	MEMB.	MAX. FACTORED	FORCE	VERT.	FACTORED	LOAD	LC1	MAX	CS1	LC2
A-B	0	35	-91.8	-91.8	0.12	(1)	10.00	C-H	-228	0	0.12	(1)											
B-C	0	24	-91.8	-91.8	0.24	(1)	10.00	H-D	0	449	0.10	(1)											
C-D	-891	0	-91.8	-91.8	0.19	(1)	6.25	H-E	-188	0	0.09	(1)											
D-E	-689	0	-91.8	-91.8	0.17	(1)	6.25	I-C	-988	0	0.50	(1)											
E-F	0	24	-91.8	-91.8	0.22	(1)	10.00	E-G	-971	0	0.44	(1)											
I-B	-269	0	0.0	0.0	0.03	(1)	7.81																
G-F	-125	0	0.0	0.0	0.01	(1)	7.81																
I-H	0	722	-18.5	-18.5	0.39	(4)	10.00																
H-G	0	677	-18.5	-18.5	0.39	(4)	10.00																

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.53")
CALCULATED VERT. DEFL. (LL) = L/889 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.53")
CALCULATED VERT. DEFL. (TL) = L/989 (0.11")

CSI: TC=0.24/1.00 (B-C:1), BC=0.39/1.00 (H-I:4), WB=0.50/1.00 (C-I:1), SSI=0.15/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (PSI) SHEAR SECTION (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.84 (E) (INPUT = 0.90)
JSI METAL = 0.35 (C) (INPUT = 1.00)

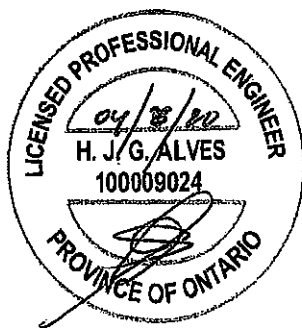


Structural component only
DWG# T-2007613

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T11B	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 2.310 S Oct 29 2019 Mittek Industries, Inc. Tue Apr 28 10:04:01 2020 Page 1

ID:DMCubINVR6TstFos31v6l_2ns11-SxVsS1cVvDTdV3g25iMsNothBxxWB?PWeSQ4izMEMI

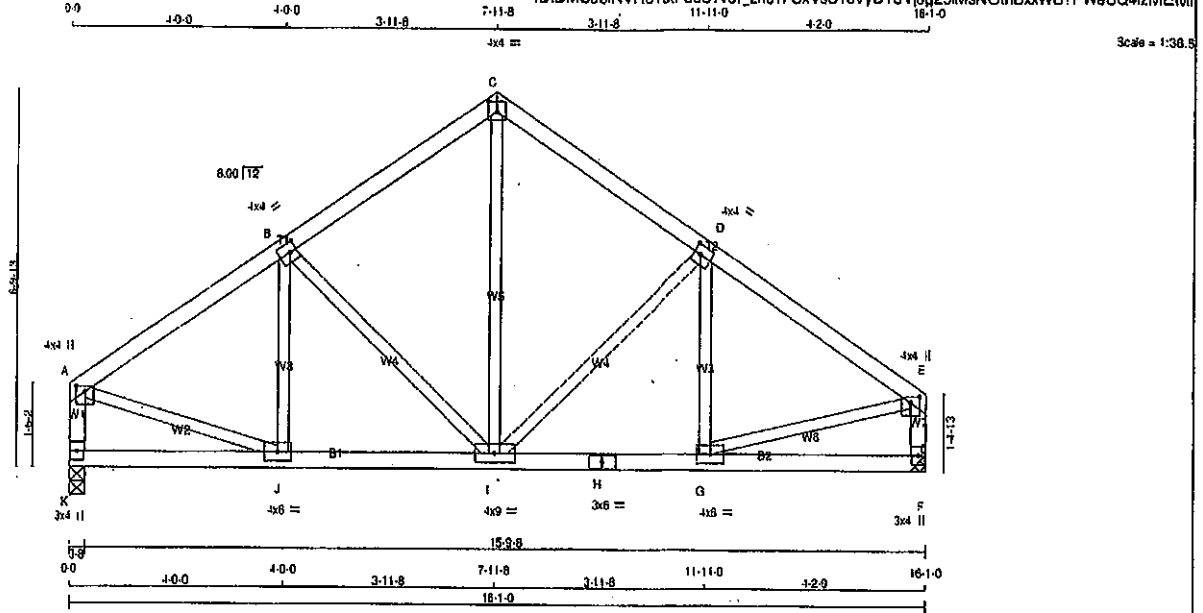

TOTAL WEIGHT = 2 X 69 = 137 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
K - A	2x4	DRY	No.2
F - E	2x4	DRY	No.2
K - H	2x4	DRY	No.2
H - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY, SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW+p	MT20	4.0	4.0	1.25 2.00
B	TMWW-i	MT20	4.0	4.0	2.00 1.50
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TMWW-i	MT20	4.0	4.0	2.00 1.50
E	TMVW+p	MT20	4.0	4.0	1.25 2.00
F	BMV1+p	MT20	3.0	4.0	
G	BMWW-i	MT20	4.0	6.0	
H	BS-i	MT20	3.0	6.0	
I	BMWW-i	MT20	4.0	9.0	
J	BMWW-i	MT20	4.0	6.0	
K	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	UPLIFT	IN-SX
K	887	0	887	0
F	887	0	887	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	827	411.0	0.0	0.0	0.0	216.0	0.0
F	827	411.0	0.0	0.0	0.0	216.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO	UNBRAC LENGTH	FR-TO			
A-B	-888 0	-91.8 -91.8 0.19 (1)	6.25	J-B	-142 18	0.04 (1)	
B-C	-887 0	-91.8 -91.8 0.18 (1)	6.25	B-I	-263 0	0.13 (1)	
C-D	-888 0	-91.8 -91.8 0.19 (1)	6.25	I-C	0 481	0.10 (1)	
D-E	-891 0	-91.8 -91.8 0.20 (1)	6.25	I-D	-292 0	0.15 (1)	
K-A	-855 0	0.0 0.0 0.09 (1)	7.81	G-D	-117 28	0.03 (1)	
F-E	-853 0	0.0 0.0 0.09 (1)	7.81	A-J	0 772	0.17 (1)	
				G-E	0 787	0.18 (1)	
K-J	0 0	-18.5 -18.5 0.07 (4)	10.00				
J-I	0 740	-18.5 -18.5 0.15 (1)	10.00				
I-H	0 781	-18.5 -18.5 0.15 (1)	10.00				
H-G	0 781	-18.5 -18.5 0.15 (1)	10.00				
G-F	0 0	-18.5 -18.5 0.07 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.8 PSF
	DL	= 6.0 PSF
BOT CH.	LL	= 0.0 PSF
	DL	= 7.4 PSF
TOTAL LOAD		= 39.0 PSF

SPACING = 24.0 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.54")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.54")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSI: TC=0.20/1.00 (D-E:1), BC=0.15/1.00 (G-I:1), WB=0.18/1.00 (E-G:1), SS=0.15/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MAX	MIN	MAX	MIN
MT20	618	354	1887 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (E) (INPUT = 0.90)
JSI METAL = 0.25 (H) (INPUT = 1.00)




Structural component only
DWG# T-2007631

JOB NAME 408222	TRUSS NAME T11S	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 M&T Industries, Inc. Tue Apr 28 09:00:13 2020 Page 1
ID:DMCubINVR6TsiFoe31v8t_zns11-YVCj26HKS3BnFRQzo81gJ7reK5PdcqyG49siazMF1W

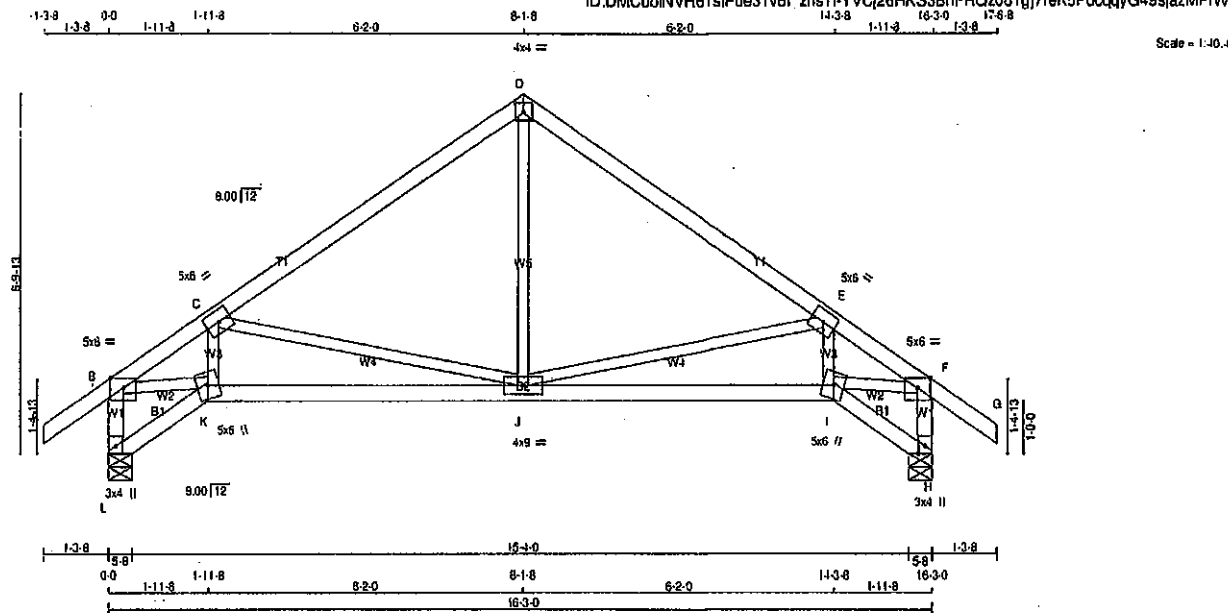

TOTAL WEIGHT = 2 X 67 = 134 lb (M/F)

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
L - B	2x4	DRY	No.2
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMWW-p	MT20	5.0	6.0	Edge
C	TMWW-l	MT20	5.0	6.0	
D	TTW-p	MT20	4.0	4.0	2.25 2.00
E	TMWW-l	MT20	5.0	6.0	
F	TMWW-p	MT20	5.0	6.0	Edge
H	BMV1+p	MT20	3.0	4.0	Edge
I	BMWW+m	MT20	5.0	6.0	
J	BMWW-l	MT20	4.0	9.0	
K	BMWW+m	MT20	5.0	6.0	
L	BMV1+p	MT20	3.0	4.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED	MAXIMUM FACTORED		INPUT	REQD		
	GROSS REACTION	GROSS REACTION		BRG	BRG		
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
L	1022	0	1022	0	0	5-8	5-8
H	1022	0	1022	0	0	5-8	5-8

UNFACTORED REACTIONS							
JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOL.
L	720	488.0	0	0	0	234	0
H	720	486.0	0	0	0	234	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.97 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH FR-TO	
FR-TO		FROM TO		FR-TO			
L-B	-1004	0	0.0 0.0 0.11 (1)	7.80	B-K	0 1321	0.30 (1)
A-B	0 35	-91.8 -91.8 0.12 (1)	10.00	K-C	0 55	0.02 (4)	
B-C	-1508	0	-91.8 -91.8 0.33 (1)	4.97	C-J	-869	0.48 (1)
C-D	-841	0	-91.8 -91.8 0.41 (1)	6.08	J-D	0 444	0.10 (1)
D-E	-841	0	-91.8 -91.8 0.42 (1)	6.07	E-J	-861	0.47 (1)
E-F	-1510	0	-91.8 -91.8 0.33 (1)	4.97	I-E	0 56	0.02 (4)
F-G	0 35	-91.8 -91.8 0.12 (1)	10.00	I-F	0 1323	0.30 (1)	
H-F	-1004	0	0.0 0.0 0.11 (1)	7.80			
L-K	0 0	-18.5 -18.5 0.02 (4)	10.00				
K-J	0 1319	-18.5 -18.5 0.33 (1)	10.00				
J-I	0 1320	-18.5 -18.5 0.33 (1)	10.00				
I-H	0 0	-18.5 -18.5 0.02 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.54")
CALCULATED VERT. DEFL. (LL) = L/999 (0.03")
ALLOWABLE DEFL. (TL) = L/360 (0.54")
CALCULATED VERT. DEFL. (TL) = L/999 (0.08")

CSI: TC=0.42/1.00 (D-E:1), BC=0.33/1.00 (J-I:1), WB=0.47/1.00 (E-J:1), SS=0.21/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1887 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (I) (INPUT = 0.90)
JSI METAL = 0.47 (K) (INPUT = 1.00)



Structural component only
DWG# T-2007614


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T12S	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:00:14 2020 Page 1

ID:DMCubINVR6TstFoe31v6I zns1I-0hm5FSlyDNJda?9MsYvGLOuJVqYLOs6VkvQG0zMFIV

Scale = 1:27.5

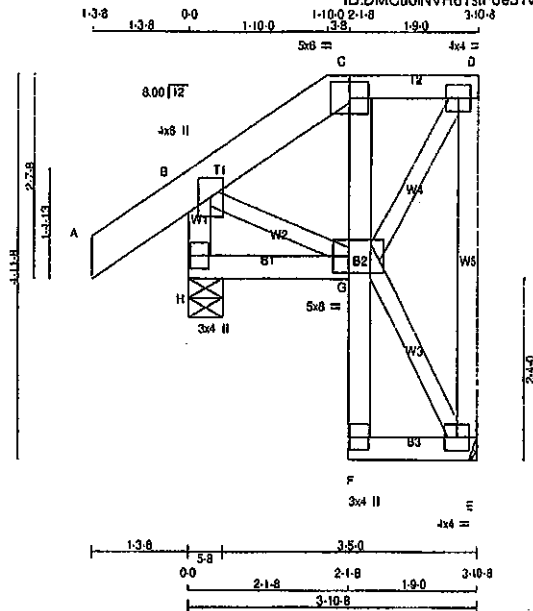

TOTAL WEIGHT = 31 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	No.2	LUMBER	DESCR.
A - C	2x8	DRY	No.2	SPF			
C - D	2x4	DRY	No.2	SPF			
E - D	2x4	DRY	No.2	SPF			
H - B	2x4	DRY	No.2	SPF			
H - G	2x4	DRY	No.2	SPF			
F - C	2x4	DRY	No.2	SPF			
F - E	2x4	DRY	No.2	SPF			
ALL WEBS	2x3	DRY	No.2	SPF			
EXCEPT							

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMW+p	MT20	4.0	8.0		
C	TV-m	MT20	5.0	8.0		
D	TMW-l	MT20	4.0	8.0		
E	BMW-l	MT20	4.0	8.0		
F	BMW-p	MT20	3.0	4.0		
G	BMW-ww-l	MT20	5.0	8.0	2.50	2.50
H	BMV-l+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
E	214	0	214	0
H	344	0	344	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	151	99	0	0	0	0	52	0
H	241	172	0	0	0	0	89	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MEMB.	MAX. FACTORED	FORCE	VERT.	FACTORED	LC1	MAX	CS1	UNBRAC	LENGTH	FR-TO	WEBS	MEMB.	MAX. FACTORED	FORCE	MAX	CS1
			(LBS)		(PLF)		(LC)								(LBS)		(LC)
A-B	0	36	-91.8	-91.8	0.07	(5)	10.00	G-D	0	139	0.03	(1)					
B-C	-105	0	-91.8	-91.8	0.03	(1)	6.25	B-G	0	95	0.02	(1)					
C-D	-79	0	-91.8	-91.8	0.05	(1)	6.25	G-E	-3	0	0.00	(1)					
E-D	-196	0	0.0	0.0	0.08	(1)	7.81										
H-B	-323	0	0.0	0.0	0.03	(1)	7.81										
H-G	0	0	-18.5	-18.5	0.03	(4)	10.00										
F-G	0	17	0.0	0.0	0.01	(1)	10.00										
G-C	-119	0	0.0	0.0	0.01	(1)	7.81										
F-E	0	2	-18.5	-18.5	0.01	(4)	10.00										

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2018
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TG=0.08:1.00 (D-E:1) . BC=0.03:1.00 (G-H:4) . WB=0.03:1.00 (D-G:1) . SSI=0.07:1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PS)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1687

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.19 (B) (INPUT = 0.90)
JSI METAL = 0.11 (B) (INPUT = 1.00)

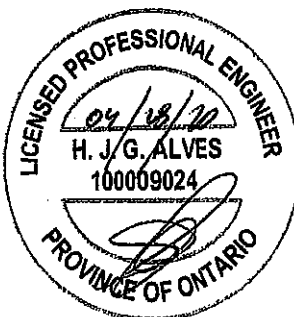

Structural component only
DWG# T-2007615

JOB NAME 408223	TRUSS NAME T20	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:04:02 2020 Page 2	
				ID:DMCubINVR6tsIFoe31vbl zns1l-x73EqNd7IXbU6s8coDbPawOPaBNFZ7YIIB c8zMEMh	

PLATES (table is in inches)

PLATE	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.75	2.75
C	TTWW-m	MT20	8.0	9.0	2.75	3.50
D	TMVW-l	MT20	5.0	8.0		
E	TMVW-w	MT20	3.0	6.0		
F	TS-l	MT20	5.0	6.0		
G	TMVW-l	MT20	5.0	8.0		
H	TTWW-m	MT20	8.0	9.0	2.75	3.50
I	TMVW-p	MT20	5.0	8.0	1.75	2.75
K	BMV1-p	MT20	3.0	6.0		
L	BMVW-l	MT20	5.0	6.0	2.50	2.75
M	BMVW-l	MT20	5.0	6.0		
N	BS-l	MT20	5.0	6.0		
O	BMVW-w-l	MT20	5.0	8.0		
P	BS-l	MT20	5.0	8.0		
Q	BMVW-l	MT20	5.0	6.0		
R	BMVW-l	MT20	5.0	8.0	2.50	2.75
S	BMV1-p	MT20	3.0	6.0		

LOADING

TOTAL LOAD CASES: (4)


CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED LC1 (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED LC1 (LBS)
FR-TO				FROM-TO			
L-AR	0 0	-18.5	-18.5 0.08 (4)	10.00			
AR-AS	0 0	-18.5	-18.5 0.08 (4)	10.00			
AS-K	0 0	-18.5	-18.5 0.08 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-10-0	-80	-87	---	FRONT	VERT	DEAD	---	C1
C	4-10-0	-311	-311	---	FRONT	VERT	SNOW	---	C1
D	11-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	30-4-0	-80	-87	---	FRONT	VERT	DEAD	---	C1
H	30-4-0	-311	-311	---	FRONT	VERT	SNOW	---	C1
N	21-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Q	11-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
R	5-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	5-2-12	-138	-138	---	FRONT	VERT	TOTAL	---	C1
U	7-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	9-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	13-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	15-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	17-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	19-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	21-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	29-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	1-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	3-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	7-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	9-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	13-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	15-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AL	17-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AM	19-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AN	23-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AO	25-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AP	27-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AQ	29-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AR	31-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AS	33-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1


CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

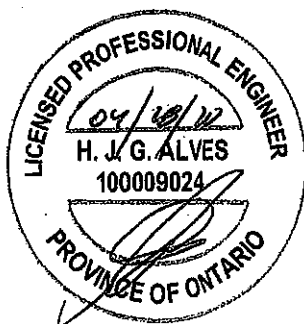

Structural component only
DWG# T-2007632

JOB NAME 408223	TRUSS NAME T21	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:04:03 2020 Page 1	
ID:DMCubINVR6TstFoe31v6l zns11-PKdclleUqLk0D3AWIqxoT6J_Wk_xSi_yxX9bzMEMg					
1-3.8 0-0 3-4.9 3-4.9 3-2.1 6-6.9 5-6.13 12-1.7 5-5.9 17-7.0 5-5.9 23-0.9 5-6.13 28-7.7 31-9.7 3-4.9 35-2.0 36-5.8 Scale = 1:57.6					

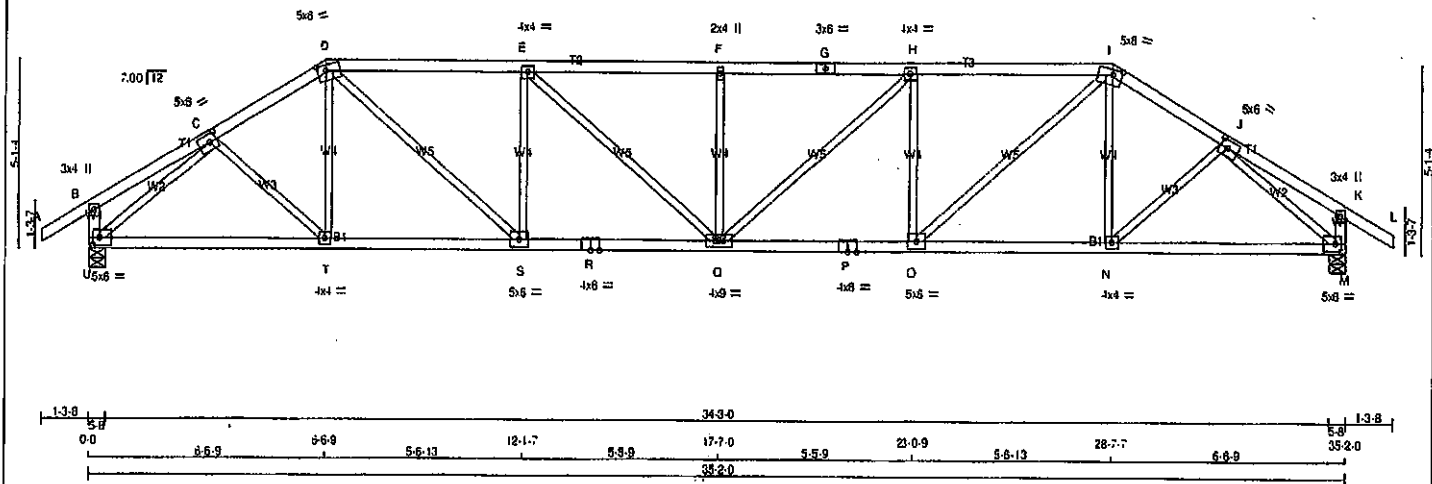

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2 SPF
G - I	2x4	DRY	No.2 SPF
L - L	2x4	DRY	No.2 SPF
U - B	2x4	DRY	No.2 SPF
M - K	2x4	DRY	No.2 SPF
U - R	2x4	DRY	No.2 SPF
R - P	2x4	DRY	No.2 SPF
P - M	2x4	DRY	No.2 SPF
ALL WEBS EXCEPT	2x3	DRY	No.2 SPF

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMVW-1	MT20	5.0	6.0	2.50	2.50
D TTWW-m	MT20	5.0	8.0	1.75	3.00
E TMVW-1	MT20	4.0	4.0		
F TMVW-w	MT20	2.0	4.0		
G TS-1	MT20	3.0	6.0		
H TMVW-1	MT20	4.0	4.0		
I TTWW-m	MT20	5.0	8.0	1.75	3.00
J TMVW-1	MT20	5.0	6.0	2.50	2.50
K TMV+p	MT20	3.0	4.0		
N BMVW-1	MT20	5.0	6.0	2.50	2.00
O BMVW-1	MT20	5.0	6.0		
P BS-1	MT20	4.0	6.0		
Q BMVW-1	MT20	4.0	6.0		
R BS-1	MT20	4.0	6.0		
S BMVW-1	MT20	5.0	6.0		
T BMVW-1	MT20	4.0	4.0		
U BMVW-1	MT20	5.0	6.0	2.50	2.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT REGRD
JT	VERT	HORZ	DOWN
U	2084	0	2084 0 0 5-8 5-8
M	2084	0	2084 0 0 5-8 5-8

UNFACTORED REACTIONS						
1ST LCASE	MAX.	MIN.	COMPONENT	REACTIONS		
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
U	1457	970	0	0:0	0 0	488 0
M	1457	970	0	0:0	0 0	488 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.12 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING			
TOTAL LOAD CASES: (4)			
CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)
FR-TO			
A-B	0 32	-91.8 -91.8 0.12 (1)	10.00
B-C	0 13	-91.8 -91.8 0.12 (1)	10.00
C-D	-2527 0	-91.8 -91.8 0.20 (1)	4.18
D-E	-3264 0	-91.8 -91.8 0.68 (1)	3.30
E-F	-3585 0	-91.8 -91.8 0.70 (1)	3.12
F-G	-3585 0	-91.8 -91.8 0.70 (1)	3.12
G-H	-3585 0	-91.8 -91.8 0.70 (1)	3.12
H-I	-3264 0	-91.8 -91.8 0.66 (1)	3.30
I-J	-2527 0	-91.8 -91.8 0.20 (1)	4.18
J-K	0 13	-91.8 -91.8 0.12 (1)	10.00
K-L	0 32	-91.8 -91.8 0.12 (1)	10.00
U-B	-249 0	0.0 0.0 0.03 (1)	7.81
M-K	-249 0	0.0 0.0 0.03 (1)	7.81
U-T	0 2005	-18.5 -18.5 0.42 (1)	10.00
T-S	0 2167	-18.5 -18.5 0.44 (1)	10.00
S-R	0 3264	-18.5 -18.5 0.58 (1)	10.00
R-Q	0 3264	-18.5 -18.5 0.58 (1)	10.00
Q-P	0 3264	-18.5 -18.5 0.58 (1)	10.00
P-O	0 3264	-18.5 -18.5 0.58 (1)	10.00
O-N	0 2167	-18.5 -18.5 0.44 (1)	10.00
N-M	0 2005	-18.5 -18.5 0.42 (1)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (11.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (11.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CSI: TC=0.70/1.00 (E-F-1), BC=0.58/1.00 (G-S-1), WB=0.82/1.00 (J-M-1), SS=0.24/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1657 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRP = 0.90 (M) INPUT = 0.90)
JSI METAL = 0.74 (R) INPUT = 1.00)




Structural component only
DWG# T-2007633

JOB NAME 408223	TRUSS NAME T22	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:04:04 2020 Page 1
ID:DMCub\NVR6TstFoe31v8I zns1\WB743eNF8rCMAoFJG3U70GFOH\TtrCcg4h1zMEM
20-7-14 26-10-14 4-3-0 30-11-3 4-2-13 35-2-0 1-3-8
Scale = 1:57.6

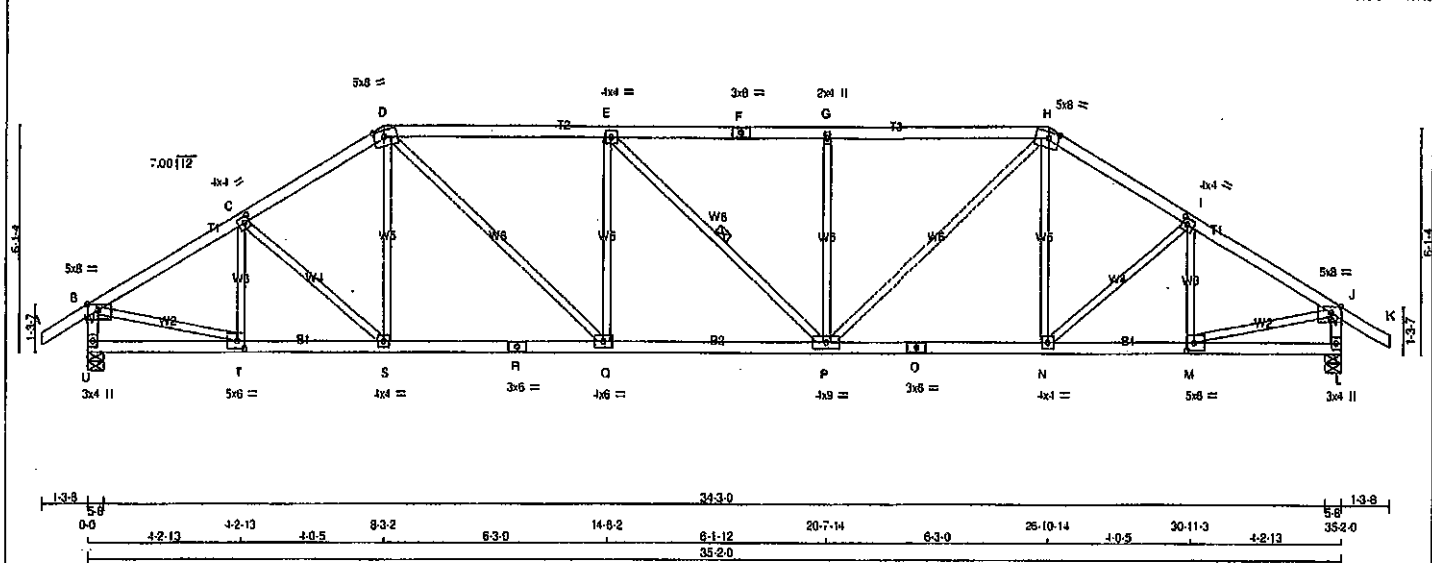

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - H	2x4	DRY No.2	SPF
H - K	2x4	DRY No.2	SPF
U - B	2x4	DRY No.2	SPF
L - J	2x4	DRY No.2	SPF
U - R	2x4	DRY No.2	SPF
R - O	2x4	DRY No.2	SPF
O - L	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	3.50
C	TMVW-i	MT20	4.0	4.0	2.00	1.75
D	TTVW-m	MT20	5.0	8.0	2.00	3.50
E	TMVW-i	MT20	4.0	4.0		
F	TS-i	MT20	3.0	6.0		
G	TMVW-m	MT20	5.0	8.0	2.00	3.50
H	TTVW-m	MT20	4.0	4.0	2.00	1.75
I	TMVW-p	MT20	5.0	8.0	Edge	3.50
L	BMV-i-p	MT20	3.0	4.0		
M	BMVW-i	MT20	5.0	8.0	2.50	2.50
N	BMVW-i	MT20	4.0	4.0		
O	BS-i	MT20	3.0	6.0		
P	BMVW-i	MT20	4.0	4.0		
Q	BMVW-i	MT20	4.0	4.0		
R	BS-i	MT20	3.0	6.0		
S	BMVW-i	MT20	4.0	4.0		
T	BMVW-i	MT20	5.0	8.0	2.50	2.50
U	BMV-i-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	GROSS REACTION	MAXIMUM FACTORED	INPUT	RECORD
	VERT	HORZ	DOWN	HORZ	UPLIFT
JT	2084	0	2084	0	5-8
U	2084	0	2084	0	5-8
L	2084	0	2084	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
U	1457	970	0	0	0	0	488	0
L	1457	970	0	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS U, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.37 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO				FR-TO			
A-B	0 32	-91.8	-91.8 0.12 (1)	10.00	T-C	-426 0	0.10 (1)
B-C	-2468 0	-91.8	-91.8 0.35 (1)	4.07	C-S	-39 0	0.02 (1)
C-D	-2478 0	-91.8	-91.8 0.34 (1)	4.08	S-D	0 131	0.04 (1)
D-E	-2910 0	-91.8	-91.8 0.75 (1)	3.37	D-Q	0 1076	0.24 (1)
E-F	-2909 0	-91.8	-91.8 0.74 (1)	3.38	Q-E	-617 0	0.36 (1)
F-G	-2909 0	-91.8	-91.8 0.74 (1)	3.38	E-P	-2 0	0.00 (1)
G-H	-2909 0	-91.8	-91.8 0.75 (1)	3.38	P-G	-617 0	0.36 (1)
H-I	-2478 0	-91.8	-91.8 0.34 (1)	4.08	P-H	0 1073	0.24 (1)
I-J	-2468 0	-91.8	-91.8 0.35 (1)	4.07	N-H	0 132	0.04 (1)
J-K	0 32	-91.8	-91.8 0.12 (1)	10.00	N-I	-39 0	0.02 (1)
U-B	-2025 0	0.0	0.0 0.21 (1)	5.94	M-I	-426 0	0.10 (1)
L-J	-2025 0	0.0	0.0 0.21 (1)	5.94	B-T	0 2205	0.50 (1)
U-T	0 0	-18.5	-18.5 0.07 (4)	10.00	M-J	0 2205	0.50 (1)
T-S	0 2149	-18.5	-18.5 0.41 (1)	10.00			
S-R	0 2122	-18.5	-18.5 0.41 (1)	10.00			
R-Q	0 2122	-18.5	-18.5 0.41 (1)	10.00			
Q-P	0 2910	-18.5	-18.5 0.54 (1)	10.00			
P-O	0 2122	-18.5	-18.5 0.41 (1)	10.00			
O-N	0 2122	-18.5	-18.5 0.41 (1)	10.00			
N-M	0 2149	-18.5	-18.5 0.41 (1)	10.00			
M-L	0 0	-18.5	-18.5 0.07 (4)	10.00			

TOTAL WEIGHT = 148 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.8 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2010
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFLECTION = L/360 (1.17")
CALCULATED VERT. DEFLECTION (LL) = L/999 (0.16")
ALLOWABLE DEFLECTION (TL) = L/360 (1.17")
CALCULATED VERT. DEFLECTION (TL) = L/999 (0.30")

CS1: TC=0.75/1.00 (D-E:1), BC=0.54/1.00 (P-Q:1), WB=0.50/1.00 (B-T:1), SS1=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY) SHEAR	SECTION
(PSI)	(PLI) (PLI)
MAX MIN	MAX MIN
MT20	618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.69 (T) (INPUT = 0.90)
JSI METAL = 0.70 (O) (INPUT = 1.00)




Structural component only
DWG# T-2007634

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T23	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 28 2019 MTek Industries, Inc. Tue Apr 28 10:04:08 2020 Page 1
ID:DMCubINVR6TslFoe31v6t zns11-pvJivKgeml5wbUyerelXZQ5aqCaVBJG8gw8BlvzMEMd

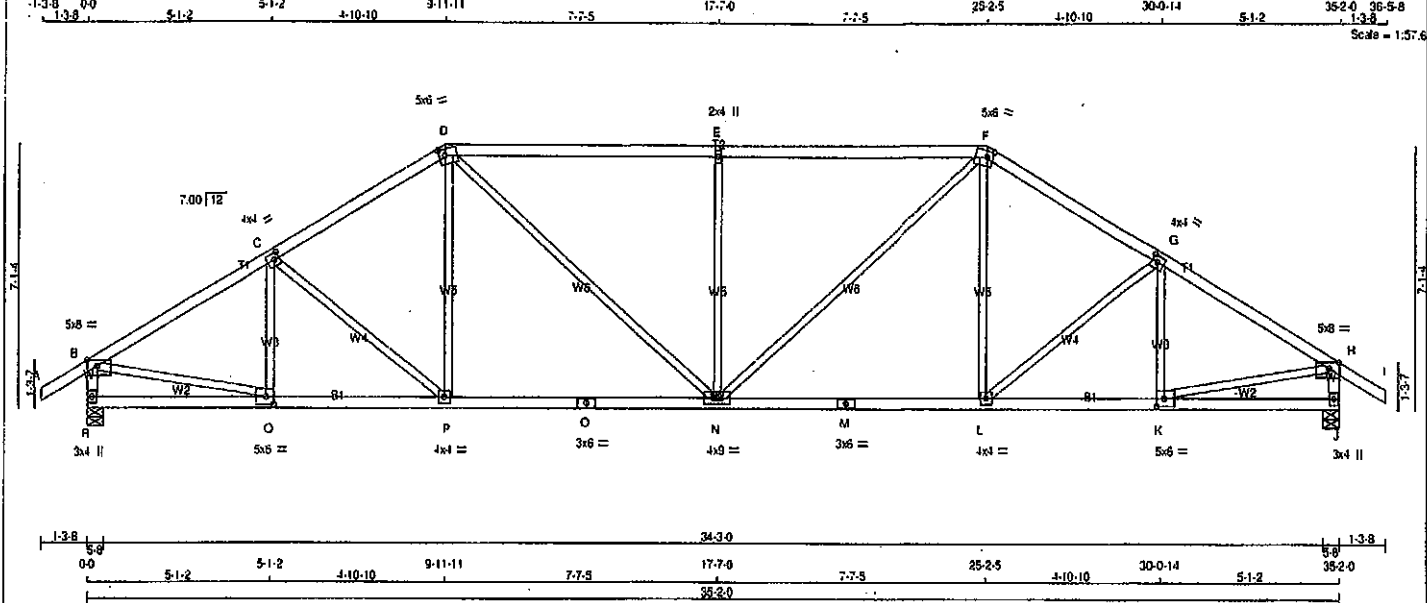

TOTAL WEIGHT = 145 lb
(M/F)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - I	2x4	DRY	No.2	SPF	
I - B	2x4	DRY	No.2	SPF	
B - H	2x4	DRY	No.2	SPF	
H - O	2x4	DRY	No.2	SPF	
O - M	2x4	DRY	No.2	SPF	
M - J	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY; SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	3.50
C	TMWW-l	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	6.0	2.00	2.00
E	TMW+u	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	6.0	2.00	2.00
G	TMWW-l	MT20	4.0	4.0	2.00	1.75
H	TMVW-p	MT20	5.0	8.0	Edge	3.50
J	BMV1+p	MT20	3.0	4.0		
K	BMWW-l	MT20	5.0	6.0	2.50	2.50
L	BMWW-l	MT20	4.0	4.0		
M	BS-l	MT20	3.0	6.0		
N	BMWWW-l	MT20	4.0	9.0		
O	BS-l	MT20	3.0	6.0		
P	BMWW-l	MT20	4.0	4.0		
Q	BMWW-l	MT20	5.0	6.0	2.50	2.50
R	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		MAXIMUM FACTORED		INPUT		REQ'D	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
R	2084	0	2084	0	0	5-8	5-8
J	2084	0	2084	0	0	5-8	5-8

UNFACTORED REACTIONS							
	1ST LOASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1457	970.0	0.0	0.0	0.0	488.0	0.0
J	1457	970.0	0.0	0.0	0.0	488.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.16 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	UNBRAC LENGTH
FR-TO		FROM TO		FR-TO			
A-B	0 32	-91.8 -91.8	0.12 (1)	10.00	Q-C	-335 0	0.09 (1)
B-C	-2537 0	-91.8 -91.8	0.39 (1)	4.00	C-P	-216 0	0.16 (1)
C-D	-2398 0	-91.8 -91.8	0.37 (1)	4.11	P-D	0 258	0.06 (4)
D-E	-2809 0	-91.8 -91.8	0.88 (1)	3.16	D-N	0 752	0.17 (1)
E-F	-2809 0	-91.8 -91.8	0.88 (1)	3.16	N-E	-880 0	0.75 (1)
F-G	-2398 0	-91.8 -91.8	0.37 (1)	4.11	N-F	0 752	0.17 (1)
G-H	-2537 0	-91.8 -91.8	0.39 (1)	4.00	L-F	0 258	0.06 (4)
H-I	0 32	-91.8 -91.8	0.12 (1)	10.00	L-G	-216 0	0.16 (1)
I-B	-2020 0	0.0 0.0	0.21 (1)	5.94	K-G	-335 0	0.09 (1)
J-H	-2020 0	0.0 0.0	0.21 (1)	5.94	B-Q	0 2283	0.51 (1)
					K-H	0 2283	0.51 (1)
R-Q	0 0	-18.5 -18.5	0.10 (4)	10.00			
Q-P	0 2213	-18.5 -18.5	0.45 (1)	10.00			
P-O	0 2048	-18.5 -18.5	0.44 (1)	10.00			
O-N	0 2048	-18.5 -18.5	0.44 (1)	10.00			
N-M	0 2048	-18.5 -18.5	0.44 (1)	10.00			
M-L	0 2048	-18.5 -18.5	0.44 (1)	10.00			
L-K	0 2213	-18.5 -18.5	0.45 (1)	10.00			
K-J	0 0	-18.5 -18.5	0.10 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.13")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.27")

CSI: TC=0.88/1.00 (E-F:1), BC=0.45/1.00 (K-L:1),
WB=0.75/1.00 (E-N:1), SSI=0.34/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (K) (INPUT = 0.90)
JSI METAL = 0.72 (M) (INPUT = 1.00)

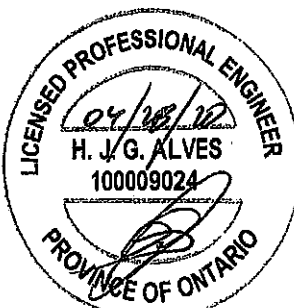

Structural component only
DWG# T-2007635

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T24	1	1	TRUSS DESC.		


Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:07 2020 Page 1

ID:DMCubINVR6TstFos31v6I_zns11-H5s7j4hGX3DnDeWqPLm8eapobw_wk9HuavkMzMEMc

352.0 36.5.8 1.3.8

Scale = 1/8" = 1'-0"

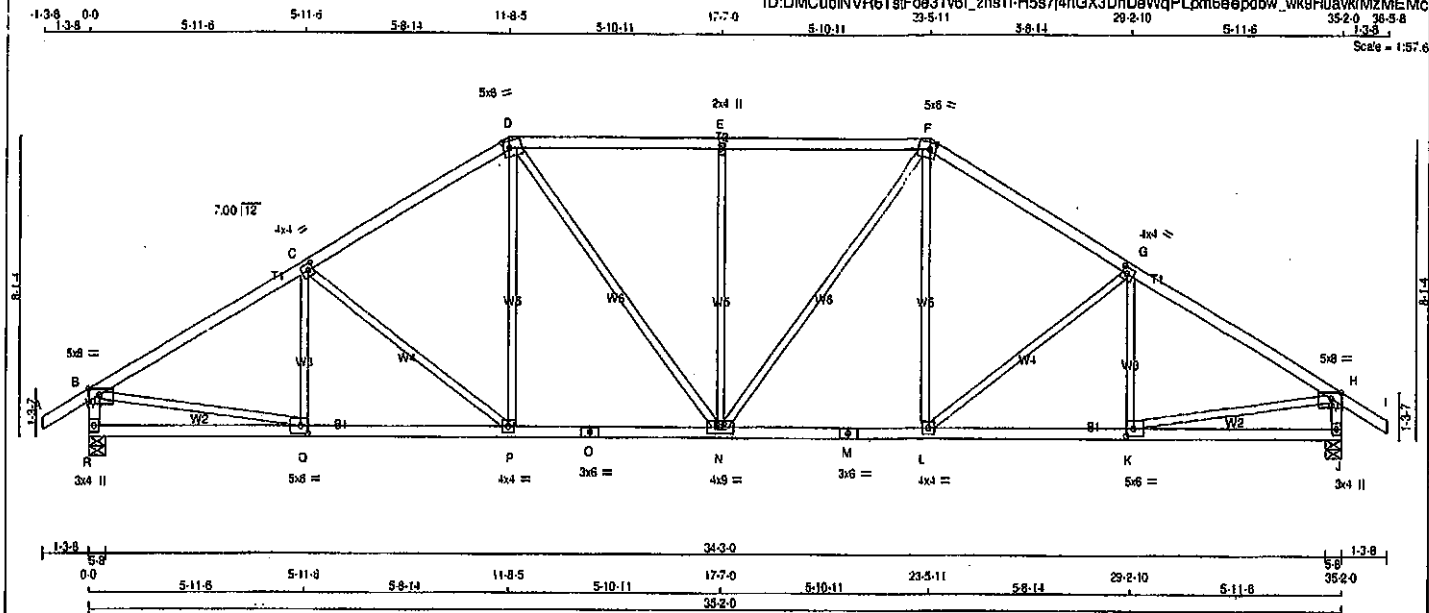

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
A - F	2x4	DRY	No.2	SPF		
F - I	2x4	DRY	No.2	SPF		
R - B	2x4	DRY	No.2	SPF		
J - H	2x4	DRY	No.2	SPF		
R - O	2x4	DRY	No.2	SPF		
O - M	2x4	DRY	No.2	SPF		
M - J	2x4	DRY	No.2	SPF		
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMW-p	MT20	5.0	8.0	Edge 3.50
C	TMW-w	MT20	4.0	4.0	2.00 1.75
D	TTW-w	MT20	5.0	6.0	2.25 2.00
E	TMW-w	MT20	2.0	4.0	
F	TTW-w	MT20	5.0	6.0	2.25 2.00
G	TMW-w	MT20	4.0	4.0	2.00 1.75
H	TMW-p	MT20	5.0	8.0	Edge 3.50
J	BMV-lp	MT20	3.0	4.0	
K	BMW-w	MT20	5.0	6.0	2.50 2.50
L	BMW-w	MT20	4.0	4.0	
M	BS-t	MT20	3.0	6.0	
N	BMW-w	MT20	4.0	4.0	2.00 1.75
O	BS-t	MT20	3.0	6.0	
P	BMW-w	MT20	4.0	4.0	
Q	BMW-w	MT20	5.0	6.0	2.50 2.50
R	BMV-lp	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
R	2084	0	2084	0
J	2084	0	2084	0

UNFACTORED REACTIONS

	1ST LCASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
R	1457	970	0	0	0	0	0	0
J	1457	970	0	0	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.81 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	MAX. UNBRACED LENGTH (FT)	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORZ. LOAD (LBS)
FR-TO						FR-TO			
A-B	0	32	-91.8	-91.8	0.12 (1)	10.00	Q-C	-252	12
B-C	-2575	0	-91.8	-91.8	0.54 (1)	3.81	C-P	-388	0
C-D	-2263	0	-91.8	-91.8	0.50 (1)	4.05	P-D	0	345
D-E	-2236	0	-91.8	-91.8	0.49 (1)	4.06	D-N	0	489
E-F	-2236	0	-91.8	-91.8	0.49 (1)	4.06	N-E	-662	0
F-G	-2263	0	-91.8	-91.8	0.50 (1)	4.05	E-F	0	489
G-H	-2575	0	-91.8	-91.8	0.54 (1)	3.81	L-F	0	345
H-I	0	32	-91.8	-91.8	0.12 (1)	10.00	L-G	-388	0
I-J	-2016	0	0.0	0.0	0.21 (1)	5.94	K-G	-252	12
J-K	-2016	0	0.0	0.0	0.21 (1)	5.94	B-Q	0	2281
							K-H	0	2281
R-Q	0	0	-18.5	-18.5	0.14 (4)	10.00			
Q-P	0	2251	-18.5	-18.5	0.43 (1)	10.00			
P-O	0	1947	-18.5	-18.5	0.38 (1)	10.00			
O-N	0	1947	-18.5	-18.5	0.38 (1)	10.00			
N-M	0	1947	-18.5	-18.5	0.38 (1)	10.00			
M-L	0	1947	-18.5	-18.5	0.38 (1)	10.00			
L-K	0	2251	-18.5	-18.5	0.43 (1)	10.00			
K-J	0	0	-18.5	-18.5	0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6	PSF
DL	= 6.0	PSF
BOT CH. LL	= 0.0	PSF
DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")
CSI: TC=0.54, 1.00 (B-C:1), BC=0.43, 1.00 (P-Q:1), WS=0.84, 1.00 (E-N:1), SS=0.26, 1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 L.S BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 518 354 1867 788 1987 1556

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (Q) (INPUT = 0.80)
JSI METAL= 0.61 (M) (INPUT = 1.00)

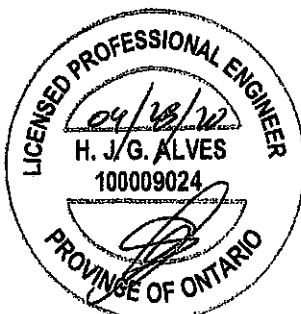


Structural component only
DWG# T-2007636

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T25	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:04:08 2020 Page 1

ID:DMCubINVR6TstFoe31v6l zns11-HQVwQhulNMdm50y3K7erAxP7FI6SR7DelqozMEMb

1-3.8 0.0 6-9.11 6-7.3 13-4.14 1-2.2 17-7.0 21-9.2 6-7.3 28-4.5 6-9.11 35-2.0 1-3.8
Scale = 1:50.3

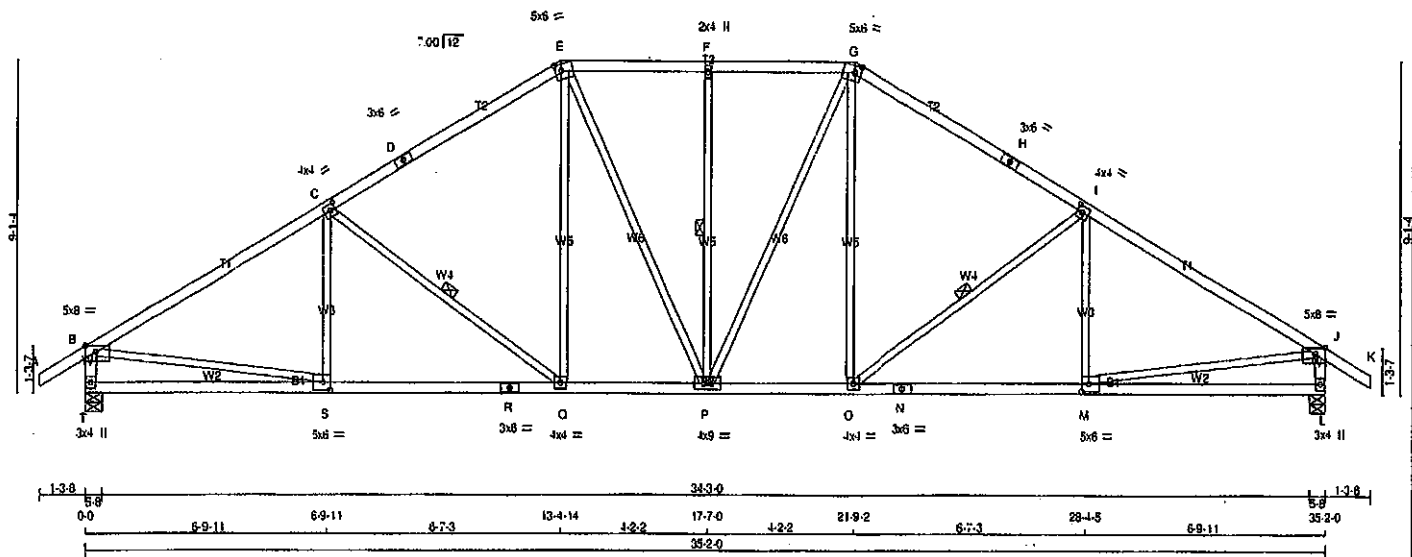

TOTAL WEIGHT = 4 X 158 = 632 lb (M/F)

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
T - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
T - R	2x4	DRY	No.2
R - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (Table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW-p	MT20	5.0	8.0 Edge 3.50
C	TMVW-i	MT20	4.0	4.0 2.00 1.75
D	TS-i	MT20	3.0	8.0
E	TTWW-m	MT20	5.0	6.0 2.25 2.00
F	TMW-w	MT20	2.0	4.0
G	TTWW-m	MT20	5.0	8.0 2.25 2.00
H	TS-i	MT20	3.0	8.0
I	TMVW-i	MT20	4.0	4.0 2.00 1.75
J	TMVW-p	MT20	5.0	8.0 Edge 3.50
L	BMV1-p	MT20	3.0	4.0
M	BMVW-i	MT20	5.0	6.0 2.50 2.50
N	BS-i	MT20	3.0	8.0
O	BMVW-i	MT20	4.0	4.0
P	BMVW-i	MT20	4.0	9.0
Q	BMVW-i	MT20	4.0	4.0
R	BS-i	MT20	3.0	8.0
S	BMVW-i	MT20	5.0	6.0 2.50 2.50
T	BMV1-p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UPLIFT
T	2064	0	2064	0
L	2064	0	2064	0

UNFACTORED REACTIONS

	1ST CASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
T	1457	970	0	0	0	488	0	0
L	1457	970	0	0	0	488	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.54 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-Q, F-P, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 32	-91.8 -91.8 0.12 (1)	10.09	S-C	-185 51	0.08 (1)	
B-C	-2590 0	-91.8 -91.8 0.74 (1)	3.54	C-Q	-548 0	0.26 (1)	
C-D	-2156 0	-91.8 -91.8 0.66 (1)	3.91	Q-E	0 431	0.10 (1)	
D-E	-2156 0	-91.8 -91.8 0.66 (1)	3.91	E-P	0 286	0.08 (1)	
E-F	-1958 0	-91.8 -91.8 0.24 (1)	4.61	P-G	-460 0	0.26 (1)	
F-G	-1958 0	-91.8 -91.8 0.24 (1)	4.61	G-H	0 286	0.08 (1)	
G-H	-2156 0	-91.8 -91.8 0.66 (1)	3.91	H-I	0 431	0.10 (1)	
H-I	-2156 0	-91.8 -91.8 0.66 (1)	3.91	I-O	-548 0	0.26 (1)	
I-J	-2590 0	-91.8 -91.8 0.74 (1)	3.54	M-L	-185 51	0.08 (1)	
J-K	0 32	-91.8 -91.8 0.12 (1)	10.09	B-S	0 2292	0.52 (1)	
T-B	-2011 0	0.0 0.0 0.20 (1)	5.95	M-J	0 2292	0.52 (1)	
L-J	-2011 0	0.0 0.0 0.20 (1)	5.95				
T-S	0 0	-18.5 -18.5 0.20 (4)	10.00				
S-R	0 2269	-18.5 -18.5 0.46 (1)	10.00				
R-Q	0 2269	-18.5 -18.5 0.46 (1)	10.00				
Q-P	0 1833	-18.5 -18.5 0.36 (1)	10.00				
P-O	0 1833	-18.5 -18.5 0.36 (1)	10.00				
O-N	0 2269	-18.5 -18.5 0.46 (1)	10.00				
N-M	0 2269	-18.5 -18.5 0.46 (1)	10.00				
M-L	0 0	-18.5 -18.5 0.20 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN PLAT SECTION BASED ON A SLOPE OF 6.0/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CS1: TC=0.74/1.00 (J-I); BC=0.46/1.00 (M-O); WB=0.52/1.00 (J-M); SS1=0.26/1.00 (J-I)

DOX LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1650

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (S) INPUT = 0.90 1
JSI METAL = 0.69 (N) INPUT = 1.00 1




Structural component only
DWG# T-2007637

JOB NAME 408223	TRUSS NAME T25A	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:04:09 2020 Page 1
ID:DMCubINVR6TsIFos31v6I zns11-DU u8mIW3gUUSgCWmaEB3j6IPbBQJwaMIOreMEMa

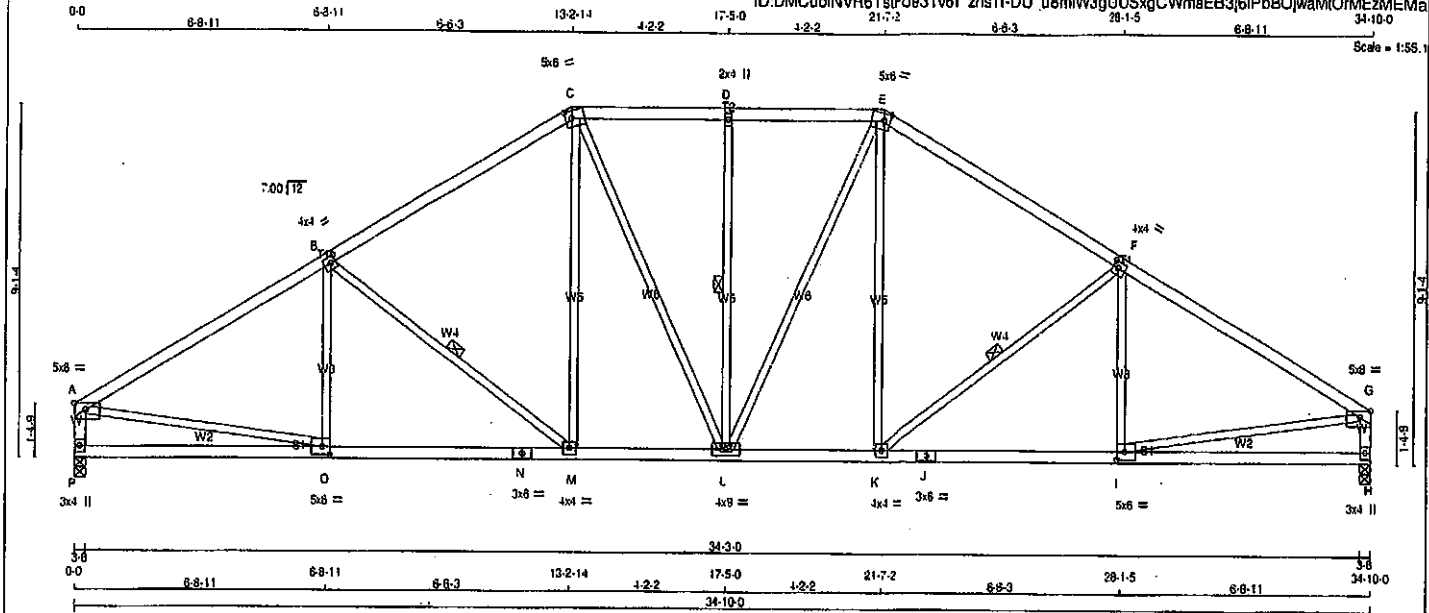

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - A	2x4	DRY	No.2
A - G	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-p	MT20	5.0	8.0	2.00 Edge
B	TMVW-t	MT20	4.0	4.0	2.00 1.75
C	TTWW-m	MT20	5.0	6.0	2.25 2.00
D	TMVW-w	MT20	2.0	4.0	
E	TTWW-m	MT20	5.0	6.0	2.25 2.00
F	TMVW-t	MT20	4.0	4.0	2.00 1.75
G	TMVW-p	MT20	5.0	8.0	Edge 3.50
H	BMV1-p	MT20	3.0	4.0	
I	BMVW-t	MT20	5.0	6.0	2.50 2.50
J	BS-t	MT20	3.0	6.0	
K	BMVW-t	MT20	4.0	4.0	
L	BMVW-w	MT20	4.0	9.0	
M	BMVW-t	MT20	4.0	4.0	
N	BS-t	MT20	3.0	6.0	
O	BMVW-t	MT20	5.0	8.0	2.50 2.50
P	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	GROSS REACTION	GROSS REACTION	GROSS REACTION	BRG	BRG	BRG	BRG
P	1920	0	1920	0	0	3-8	3-8	3-8	3-8
H	1920	0	1920	0	0	3-8	3-8	3-8	3-8

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
P	1358	891 0	0 0	0 0	0 0	467 0	0 0
H	1358	891 0	0 0	0 0	0 0	467 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.64 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF B-M, D-L, F-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)
FR-TO		FROM TO		LENGTH	FR-TO		
A-B	-2510	0	-81.8 -91.8 0.71 (1)	3.84	O-B	-212 40	0.09 (1)
B-C	-2113	0	-81.8 -91.8 0.83 (1)	3.99	B-M	-510 0	0.24 (1)
C-D	-1919	0	-81.8 -91.8 0.24 (1)	4.84	M-C	0 412	0.09 (1)
D-E	-1919	0	-81.8 -91.8 0.24 (1)	4.64	C-L	0 287	0.08 (1)
E-F	-2113	0	-81.8 -91.8 0.83 (1)	3.99	L-D	-481 0	0.25 (1)
F-G	-2510	0	-81.8 -91.8 0.71 (1)	3.84	L-E	0 287	0.08 (1)
P-A	-1858	0.0	0.0 0.0 0.19 (1)	8.13	K-E	0 412	0.09 (1)
H-G	-1858	0.0	0.0 0.0 0.19 (1)	8.13	K-F	-510 0	0.24 (1)
					I-F	-212 40	0.09 (1)
P-O	0 0	-18.5	-18.5 0.20 (4)	10.00	A-O	0 2227	0.50 (1)
O-N	0 2169	-18.5	-18.5 0.45 (1)	10.00	I-G	0 2227	0.50 (1)
N-M	0 2169	-18.5	-18.5 0.45 (1)	10.00			
M-L	0 1797	-18.5	-18.5 0.35 (1)	10.00			
L-K	0 1797	-18.5	-18.5 0.35 (1)	10.00			
K-J	0 2169	-18.5	-18.5 0.45 (1)	10.00			
J-I	0 2169	-18.5	-18.5 0.45 (1)	10.00			
I-H	0 0	-18.5	-18.5 0.20 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (1.16")
CALCULATED VERT. DEFL.(LL) = L/998 (0.11")
ALLOWABLE DEFL.(TL) = L/380 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.21")

CSI: TC=0.71 1.00 (A-B:1), BC=0.45 1.00 (M-O:1), WB=0.50 1.00 (A-O:1), SSI=0.28 1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (I) (INPUT = 0.90)
JSI METAL= 0.66 (N) (INPUT = 1.00)



Structural component only
DWG# T-2007638

JOB NAME 408223	TRUSS NAME T28	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:04:10 2020 Page 1	
				ID:DMCubINVR6TsfFoe31v8l zns1l-qYGL6j8q_cL45FP4UNTkGGKpt777_kbX7PuhzMEMZ	
Scale = 1:54.8					

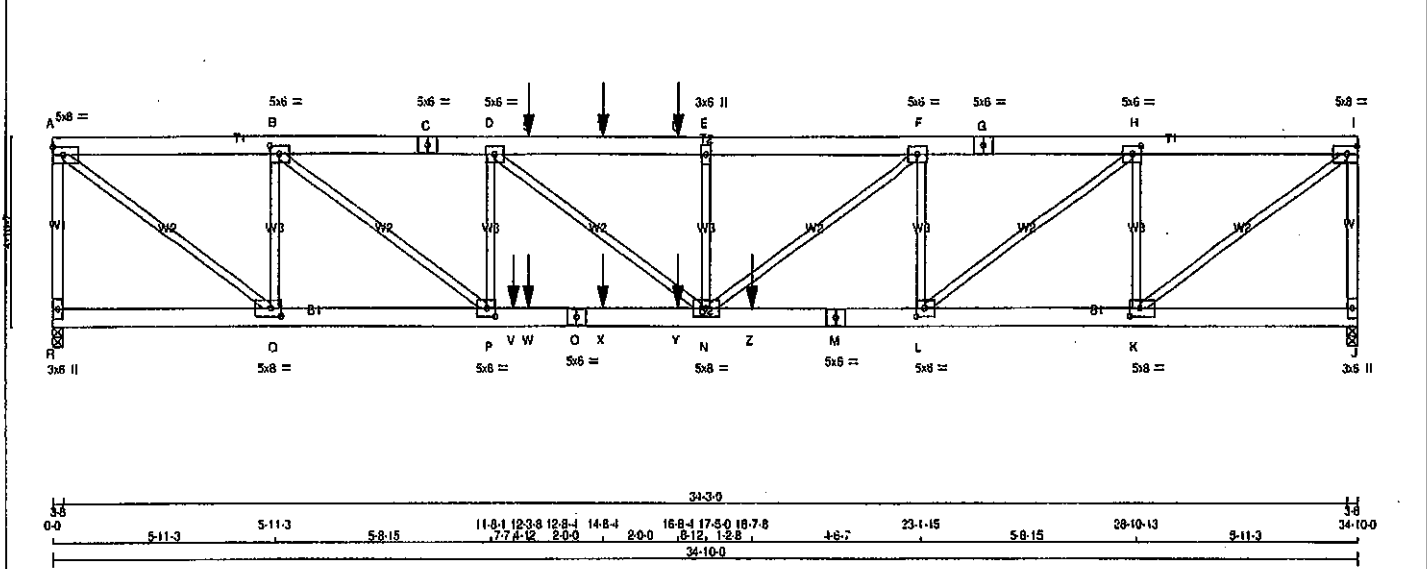

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
R - A	2x4	DRY No.2	SPF
A - C	2x6	DRY No.2	SPF
C - G	2x6	DRY No.2	SPF
G - I	2x6	DRY No.2	SPF
I - J	2x4	DRY No.2	SPF
J - O	2x6	DRY No.2	SPF
O - M	2x6	DRY No.2	SPF
M - J	2x6	DRY No.2	SPF
ALL WEBS 2x3 DRY No.2 SPF			
DRY: SEASONED LUMBER.			

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (10.122"x3") SPIRAL NAILS		
R - A 1 12	TOP	
I - J 1 12	TOP	
A - C 2 12	TOP	
C - G 2 12	TOP	
G - I 2 12	TOP	
BOTTOM CHORDS : (10.122"x3") SPIRAL NAILS		
R - O 2 12	SIDE(0.0)	
O - M 2 12	SIDE(0.0)	
M - J 2 12	TOP	
WEBS : (10.122"x3") SPIRAL NAILS		
2x3 1 6		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS	REACTION	DOWN	HORIZ	BRG	IN-SX	BRG	IN-SX
R	3373	0	3373	0	0	3-8	3-8		
J	3103	0	3103	0	0	3-8	3-8		

UNFACTORED REACTIONS		1ST CASE		MAX. MIN. COMPONENT REACTIONS		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	DEAD	SOIL
R	2380	1591	0	0	0	789	0	0	0
J	2190	1459	0	0	0	731	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.03 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. CS1 (LC)	MEMB.	FORCE (LBS)	MAX. CS1 (LC)	MAX. CS1 (LC)
FR-TO		FROM TO	CS1 (LC)	FR-TO			
R-A	-3316 0	0.0	0.0 0.58 (1)	8.39	K-I	0 4719	0.58 (1)
A-B	-4149 0	-91.8	-91.8 0.14 (1)	5.47	A-Q	0 5171	0.84 (1)
B-C	-7288 0	-91.8	-91.8 0.20 (1)	4.33	K-H	-2757 0	0.44 (1)
C-D	-7288 0	-91.8	-91.8 0.20 (1)	4.33	Q-B	-2997 0	0.48 (1)
D-S	-8278 0	-91.8	-91.8 0.28 (1)	4.03	L-H	0 3530	0.44 (1)
S-T	-8278 0	-91.8	-91.8 0.28 (1)	4.03	B-P	0 3958	0.49 (1)
T-U	-8278 0	-91.8	-91.8 0.28 (1)	4.03	L-F	-1791 0	0.28 (1)
U-E	-8278 0	-91.8	-91.8 0.28 (1)	4.03	P-D	-1403 0	0.22 (1)
E-F	-8278 0	-91.8	-91.8 0.21 (1)	4.11	N-F	0 2134	0.26 (1)
F-G	-6586 0	-91.8	-91.8 0.19 (1)	4.52	D-N	0 1249	0.15 (1)
G-H	-6586 0	-91.8	-91.8 0.19 (1)	4.52	N-E	-873 0	0.11 (1)
H-I	-3787 0	-91.8	-91.8 0.13 (1)	5.68			
J-I	-3042 0	0.0	0.0 0.51 (1)	6.02			

FR-TO	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
R-Q	0	0	-18.5	-18.5	0.04 (4)	10.00			
Q-P	0	4149	-18.5	-18.5	0.30 (1)	10.00			
P-V	0	7288	-18.5	-18.5	0.87 (1)	10.00			
V-W	0	7288	-18.5	-18.5	0.87 (1)	10.00			
W-O	0	7288	-18.5	-18.5	0.87 (1)	10.00			
O-X	0	7288	-18.5	-18.5	0.87 (1)	10.00			
X-Y	0	7288	-18.5	-18.5	0.87 (1)	10.00			
Y-N	0	7288	-18.5	-18.5	0.87 (1)	10.00			
N-Z	0	6586	-18.5	-18.5	0.72 (1)	10.00			
Z-M	0	6586	-18.5	-18.5	0.72 (1)	10.00			
M-L	0	6586	-18.5	-18.5	0.72 (1)	10.00			
L-K	0	3787	-18.5	-18.5	0.32 (1)	10.00			
K-J	0	0	-18.5	-18.5	0.04 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)		LOC.		MAX.		FACE		DIR.		TYPE		HEEL		CONN.	
JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.						
S	12-8-4	-88	-88	---	BACK	VERT	TOTAL	---	C1						
T	14-8-4	-86	-86	---	BACK	VERT	TOTAL	---	C1						
U	16-8-4	-88	-88	---	BACK	VERT	TOTAL	---	C1						
V	12-3-8	-1052	-1052	---	BACK	VERT	TOTAL	---	C1						
W	12-8-4	-17	-17	---	BACK	VERT	TOTAL	---	C1						
X	14-8-4	-17	-17	---	BACK	VERT	TOTAL	---	C1						
Y	16-8-4	-17	-17	---	BACK	VERT	TOTAL	---	C1						
Z	18-7-8	-1273	-1273	---	BACK	VERT	TOTAL	---	C1						

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CSI: TC=0.56/1.00 (A-R:1), BC=0.72/1.00 (L-N:1), WB=0.64/1.00 (A-Q:1), SSI=0.37/1.00 (L-N:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (I) (INPUT = 0.90)
JSI METAL = 0.73 (M) (INPUT = 1.00)



Structural component only
DWG# T-2007639 1/2

JOB NAME 408223	TRUSS NAME T28	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MTak Industries, Inc. Tue Apr 28 10:04:10 2020 Page 2 ID:DMQubINVR6TslF0e31y8l zns1l-jqYGL68g cl45FP4UNTKGGKlp777 kbX7PuhzMEMZ	

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-I	MT20	5.0	8.0	2.50	3.25
B	TMVW-I	MT20	5.0	8.0	2.50	2.75
C	TS-I	MT20	5.0	8.0		
D	TMVW-I	MT20	5.0	8.0		
E	TMVW-w	MT20	3.0	8.0		
F	TMVW-I	MT20	5.0	8.0		
G	TS-I	MT20	5.0	8.0		
H	TMVW-I	MT20	5.0	8.0	2.50	2.75
I	TMVW-I	MT20	5.0	8.0	2.50	3.25
J	BMV1+p	MT20	3.0	8.0		
K	BMVW-I	MT20	5.0	8.0	2.50	3.25
L	BMVW-I	MT20	5.0	8.0	2.50	2.75
M	BS-I	MT20	5.0	8.0		
N	BMVW-I	MT20	5.0	8.0		
O	BS-I	MT20	5.0	8.0		
P	BMVW-I	MT20	5.0	8.0	2.50	2.75
Q	BMVW-I	MT20	5.0	8.0	2.50	3.25
R	BMV1+p	MT20	3.0	8.0		

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER MECHANICAL CONNECTION IS REQUIRED.


Structural component only
DWG# T-2007639 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T29	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:04:11 2020 Page 1
ID:DMCubINVR6TsfFoe31v6l zns11-As6eYSkmbkCfQbeBuIGUoUPDIjsbAtpBlyR7zMEMY

0-0 5-10-8 5-10-8 5-9-1 11-7-12 5-9-1 17-5-0 5-9-1 23-2-4 5-9-1 28-11-8 5-10-8 34-10-0
Scale = 1:54.8

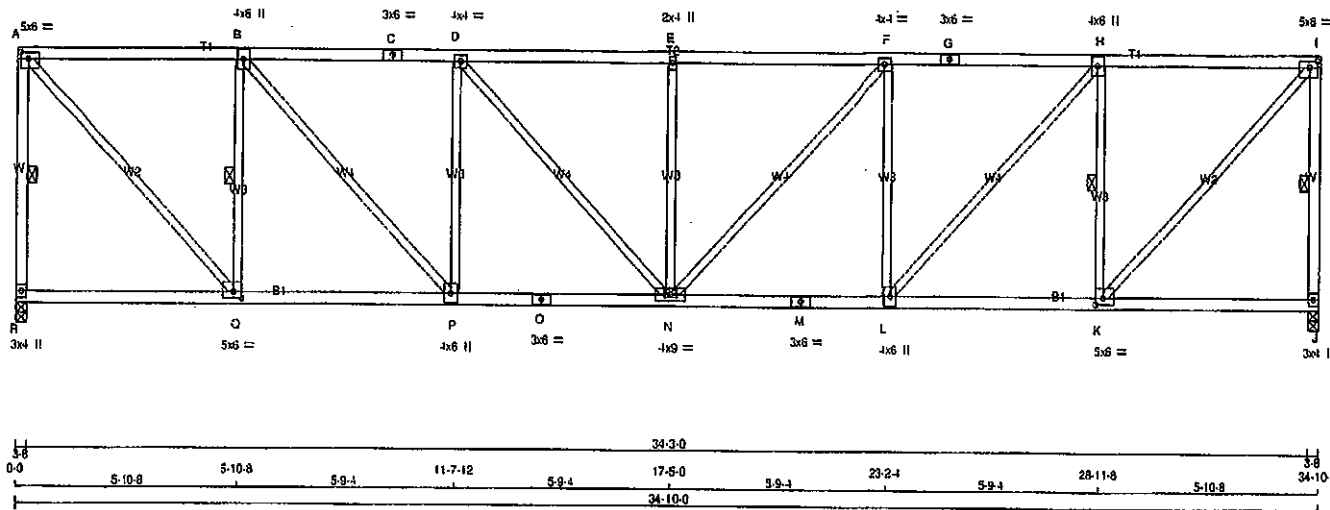

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR
R - A	2x4 DRY	No.2	SPF		
A - C	2x4 DRY	No.2	SPF		
C - G	2x4 DRY	No.2	SPF		
G - I	2x4 DRY	No.2	SPF		
J - I	2x4 DRY	No.2	SPF		
R - O	2x4 DRY	No.2	SPF		
O - M	2x4 DRY	No.2	SPF		
M - J	2x4 DRY	No.2	SPF		
ALL WEBS	2x3 DRY	No.2	SPF		
ORY: SEASONED LUMBER.					

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS									
	FACTORED	MAXIMUM FACTORED	INPUT	RECORD					
	GROSS REACTION	GROSS REACTION	BRG	BRG					
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX			
R	1920	0	1920	0	0	3-8	3-8		
J	1920	0	1920	0	0	3-8	3-8		

UNFACTORED REACTIONS

1ST CASE	MAX.	MIN.	COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
R	1358	891	0	0	0	0	467	0	0
J	1358	891	0	0	0	0	467	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-R, I-J, G-Q, H-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM TO		FR-TO			
R-A	-1876	0	0.0	0.37 (1)	A-Q	0	2281
A-B	-1563	0	-91.8	-91.8	0.53 (1)	Q-B	-1540
B-C	-2428	0	-91.8	-91.8	0.83 (1)	B-P	0
C-D	-2428	0	-91.8	-91.8	0.83 (1)	P-D	-831
D-E	-2725	0	-91.8	-91.8	0.58 (1)	D-N	0
E-F	-2725	0	-91.8	-91.8	0.58 (1)	N-E	-539
F-G	-2428	0	-91.8	-91.8	0.83 (1)	G-F	0
G-H	-2428	0	-91.8	-91.8	0.83 (1)	H-G	0
H-I	-1583	0	-91.8	-91.8	0.53 (1)	I-H	-831
I-J	-1876	0	0.0	0.37 (1)	J-I	0	1272
R-Q	0	0	-18.5	-18.5	0.15 (4)	Q-R	0
Q-P	0	1583	-18.5	-18.5	0.33 (1)	P-Q	0
P-O	0	2428	-18.5	-18.5	0.44 (1)	O-P	0
O-N	0	2428	-18.5	-18.5	0.44 (1)	N-O	0
N-M	0	2428	-18.5	-18.5	0.44 (1)	M-N	0
M-L	0	2428	-18.5	-18.5	0.44 (1)	L-M	0
L-K	0	1583	-18.5	-18.5	0.33 (1)	K-L	0
K-J	0	0	-18.5	-18.5	0.15 (4)	J-K	0

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.8 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN./G.C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEF.(LL) = L/360 (1.16")
CALCULATED VERT. DEF.(LL) = L/999 (0.16")
ALLOWABLE DEF.(TL) = L/360 (1.16")
CALCULATED VERT. DEF.(TL) = L/999 (0.31")

CSK: TC=0.63/1.00 (F-H:1), BC=0.44/1.00 (N-P:1).
WB=0.58/1.00 (F-L:1), SS=0.25/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (A) (INPUT = 0.80)
JSI METAL = 0.78 (M) (INPUT = 1.00)

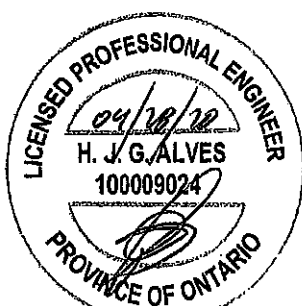


Structural component only
DWG# T-2007640

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T30	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.3.10 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:12 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-s3g0mokOMbsJPPnBvXphLb5odJb7s02rcVzZMEMX

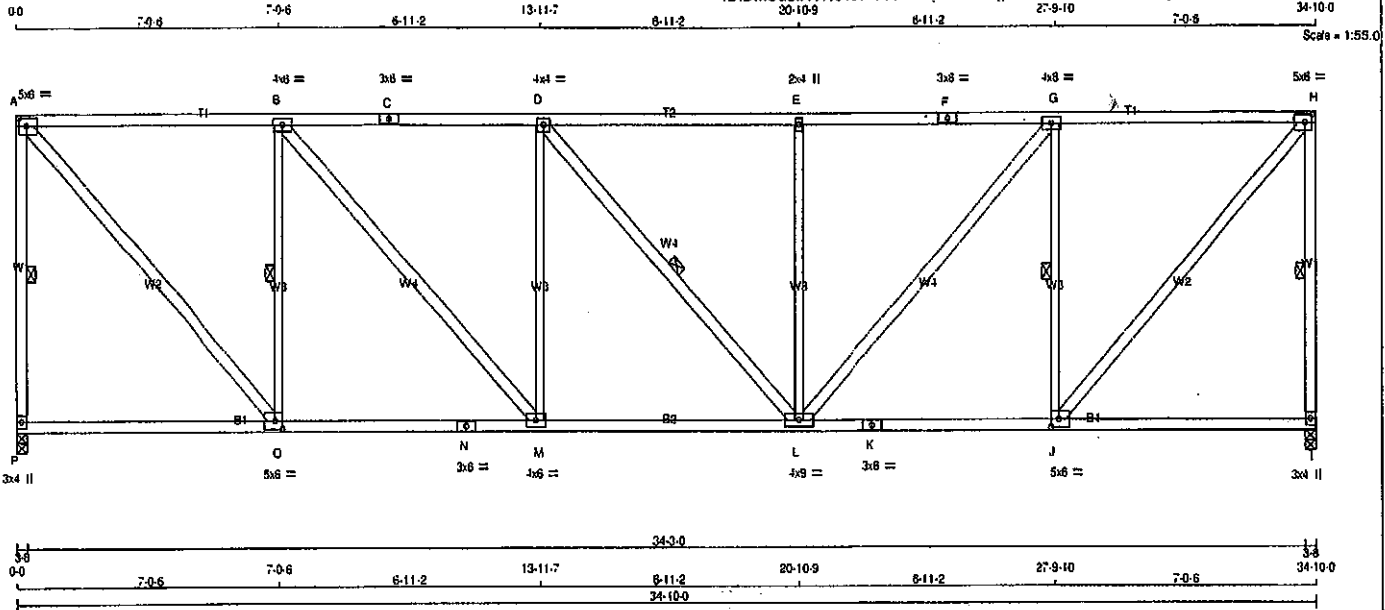

TOTAL WEIGHT = 2 X 179 = 359 lb

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N.L. G.A. RULES				
P - A	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
C - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
I - H	2x4	DRY	No.2	SPF
P - N	2x4	DRY	No.2	SPF
N - K	2x4	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF
ALL WEBS	2x4	DRY	No.2	SPF
EXCEPT				
O - B	2x3	DRY	No.2	SPF
M - D	2x3	DRY	No.2	SPF
L - E	2x3	DRY	No.2	SPF
J - G	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWW-I	MT20	5.0	6.0	2.50	2.50
B	TMWW-I	MT20	4.0	6.0		
C	TS-I	MT20	3.0	6.0		
D	TMWW-I	MT20	4.0	4.0		
E	TMWW-I	MT20	2.0	4.0		
F	TS-I	MT20	3.0	6.0		
G	TMWW-I	MT20	4.0	6.0		
H	TMWW-I	MT20	5.0	6.0	2.50	2.50
I	BMV1+p	MT20	3.0	4.0		
J	BMWW-I	MT20	5.0	6.0	2.50	2.50
K	BS-I	MT20	3.0	6.0		
L	BMWW-I	MT20	4.0	6.0		
M	BMWW-I	MT20	4.0	6.0		
N	BS-I	MT20	3.0	6.0		
O	BMWW-I	MT20	5.0	6.0	2.50	2.50
P	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
P	1920	0	1920	0
I	1920	0	1920	0

UNFACTORED REACTIONS

1ST LCASE	MAX	MIN	COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
P	1358	891	0	0	0	0	467	0	0
I	1358	891	0	0	0	0	467	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.60 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-P, H-I, B-O, D-L, G-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
P-A	-1868	0	A-O	0 2158
A-B	-1432	0	O-B	-1466
B-C	-2081	0	B-M	0 985
C-D	-2081	0	M-D	-617
D-E	-2080	0	D-L	-2
E-F	-2080	0	L-E	-616
F-G	-2080	0	G-L	0 984
G-H	-1432	0	L-G	-1465
H-I	-1868	0	I-H	0 2158
P-O	0	-18.5	O-N	0
O-N	0	-18.5	N-M	0
N-M	0	-18.5	M-L	0
M-L	0	-18.5	L-K	0
L-K	0	-18.5	K-J	0
K-J	0	-18.5	J-I	0
J-I	0	-18.5		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.89/1.00 (E-G:1), BC=0.42/1.00 (L-M:1), WB=0.81/1.00 (D-M:1), SI=0.30/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1859

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.87 (H) (INPUT = 0.90)

JSI METAL= 0.46 (K) (INPUT = 1.00)

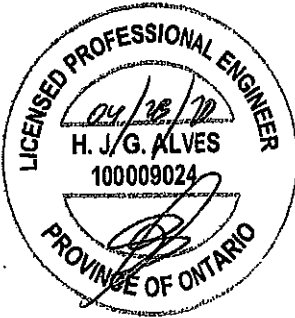


Structural component only
DWG# T-2007641

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T31	5	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		Version 3.310 S Oct 23 2019 Mitek Industries, Inc. Tue Apr 28 10:04:14 2020 Page 1			
		ID:DMCubINVR8TsFoe31v6l_zns1l-aRomBTmfuD6nZJAZKRPu6QxnQKq3sxJV95c1SzMEMV			
		20-10-9 27-9-10 34-10-0			
		34-10-0			

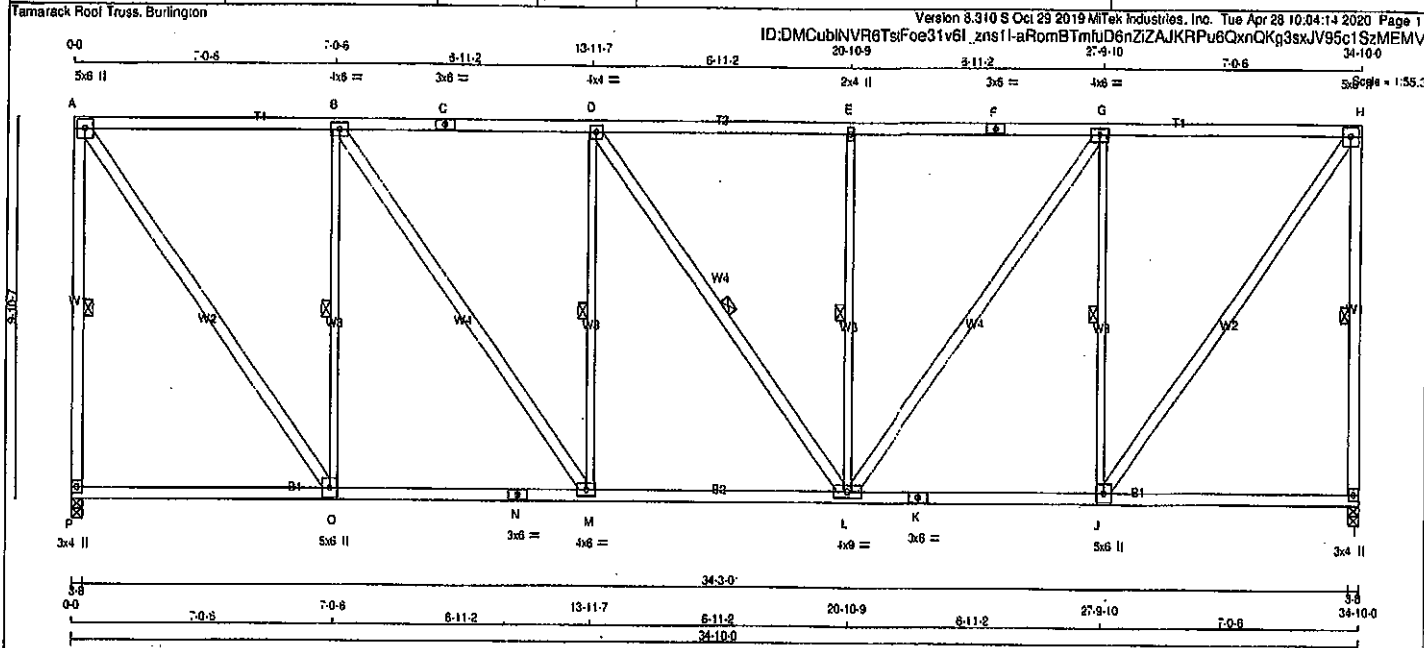

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
P - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
I - H	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
ALL WEBS	2x4	DRY	No.2
EXCEPT			
O - B	2x3	DRY	No.2
M - D	2x3	DRY	No.2
L - E	2x3	DRY	No.2
J - G	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)			
JT	TYPE	PLATES	W LEN Y X
A	TMVW+p	MT20	5.0 6.0
B	TMVW-I	MT20	4.0 6.0
C	TS-1	MT20	3.0 6.0
D	TMVW-I	MT20	4.0 4.0
E	TMVW+V	MT20	2.0 4.0
F	TS-1	MT20	4.0 6.0
G	TMVW-I	MT20	3.0 6.0
H	TMVW+p	MT20	5.0 6.0
I	BMV1+p	MT20	3.0 4.0
J	BMVW-I	MT20	5.0 6.0
K	BS-I	MT20	3.0 6.0
L	BMVW+I	MT20	4.0 6.0
M	BMVW-I	MT20	4.0 6.0
N	BS-I	MT20	3.0 6.0
O	BMVW+I	MT20	5.0 6.0
P	BMV1+p	MT20	3.0 4.0

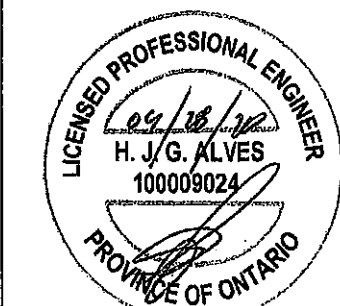

Structural component only
DWG# T-2007642

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
		GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UP/LIFT	IN-SX
P	1920	0	1920	0	3-8
I	1920	0	1920	0	3-8

UNFACTORED REACTIONS

1ST LOASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
P	1358	891	0	0-0	0-0	467	0-0
I	1358	891	0	0-0	0-0	467	0-0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.96 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-P, H-I, B-O, D-M, O-L, E-L, G-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	FORCE (LBS)	MEMB.	FORCE (LBS)
FR-TO	FROM	FR-TO	FROM
P-A	-1868 0	A-O	0 1999
A-B	-1183 0	O-B	-1468 0
B-C	-1719 0	C-B	0 916
C-D	-1719 0	D-B	-917 0
D-E	-1718 0	E-L	-2 0
E-F	-1718 0	F-L	-918 0
F-G	-1718 0	G-L	0 913
G-H	-1183 0	H-G	-1465 0
H-I	-1868 0	I-H	0 2000
P-O	0 0	O-P	-18.5 -18.5 0.22 (4)
O-N	0 1183	N-O	-18.5 -18.5 0.32 (4)
N-M	0 1183	M-N	-18.5 -18.5 0.32 (4)
M-L	0 1719	L-M	-18.5 -18.5 0.36 (1)
L-K	0 1183	K-L	-18.5 -18.5 0.32 (4)
K-J	0 1183	J-K	-18.5 -18.5 0.32 (4)
J-I	0 0	I-J	-18.5 -18.5 0.22 (4)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CSK TC=0.88/1.00 (H-I), BC=0.38/1.00 (L-M), WS=0.98/1.00 (B-O), SS=0.30/1.00 (G-H)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1997 1658


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.85 (H) (INPUT = 0.90)
JSI METAL=0.43 (H) (INPUT = 1.00)

JOB NAME 408223	TRUSS NAME T32	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington ID:DMCubINVR6TsfFoe31v6L_zns11-2dL9OpnHWEeAs8Mt1yeRKzCFqhAoVA4tkprAauzMEMU Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:04:15 2020 Page 1

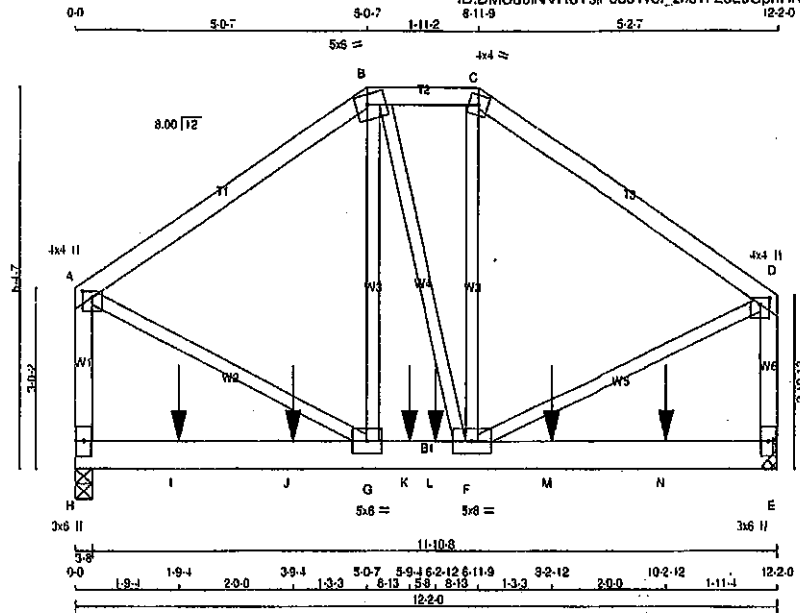

TOTAL WEIGHT = 68 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMVW+p	MT20	4.0	4.0 1.25 2.00
B	TTWW-m	MT20	5.0	6.0 2.00 2.25
C	TTW-m	MT20	4.0	4.0
D	TMVW+p	MT20	4.0	4.0 1.25 2.00
E	BMVW+p	MT20	3.0	6.0
F	BMVW-w	MT20	5.0	8.0
G	BMVW-w	MT20	5.0	6.0
H	BMVW+p	MT20	3.0	6.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQRD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
H	1233	0	1233	0	3-8
E	1218	0	1218	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 3-8.

UNFACTORED REACTIONS

JT	1ST LOASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
H	COMBINED	SNOW	LIVE	0	0	0
E	867	588	0	0	271	0
	896	588	0	0	268	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	MAX.	MEMB.	MAX. FACTORED	FACTORED	MAX.
	FORCE	VERT. LOAD LC1	MAX.		FORCE	FORCE	MAX.
	(LBS)	(PLF)	CSI (LC)		(LBS)	CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	-853	0	-91.8 -91.8 0.48 (1)	5.88	G-B	0	122 0.03 (1)
B-C	-721	0	-91.8 -91.8 0.07 (1)	8.25	B-F	0	34 0.01 (1)
C-D	-884	0	-91.8 -91.8 0.51 (1)	5.77	F-C	0	154 0.04 (1)
H-A	-1065	0	0.0 0.0 0.17 (1)	7.60	A-G	0	785 0.20 (1)
E-D	-1057	0	0.0 0.0 0.18 (1)	7.83	F-D	0	794 0.20 (1)
H-I	0	0	-18.5 -18.5 0.20 (1)	10.00			
I-J	0	0	-18.5 -18.5 0.20 (1)	10.00			
J-K	0	0	-18.5 -18.5 0.20 (1)	10.00			
G-K	0	711	-18.5 -18.5 0.28 (1)	10.00			
K-L	0	711	-18.5 -18.5 0.28 (1)	10.00			
L-F	0	711	-18.5 -18.5 0.28 (1)	10.00			
F-M	0	0	-18.5 -18.5 0.20 (1)	10.00			
M-N	0	0	-18.5 -18.5 0.20 (1)	10.00			
N-E	0	0	-18.5 -18.5 0.20 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
I	1-9-4	-172	-172	---	BACK	VERT	TOTAL	C1
J	3-9-4	-195	-195	---	BACK	VERT	TOTAL	C1
K	5-9-4	-187	-187	---	BACK	VERT	TOTAL	C1
L	6-2-12	-187	-187	---	BACK	VERT	TOTAL	C1
M	6-2-12	-195	-195	---	BACK	VERT	TOTAL	C1
N	10-2-12	-172	-172	---	BACK	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.41")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.41")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.51 (C-D:1), BC=0.28 (1.00) (F-G:1)

WB=0.20 (1.00) (A-G:1), SS=0.20 (1.00) (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MT20	818	354	1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.78 (0) (INPUT = 0.90)
JSI METAL= 0.23 (0) (INPUT = 1.00)



Structural component only
DWG# T-2007643


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T34S	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:04:16 2020 Page 1

ID:DMCubINVR6TsiFoe31v6l_zns1l-WqvXc9ovQqMVo0IZQKUtZXSIE5FX?yozTajBkzMlEMT

Scale = 1:30.1

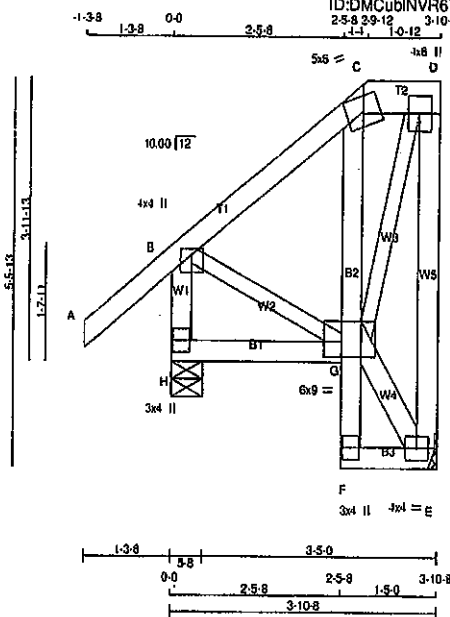

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - D	2x6	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	
H - B	2x4	DRY	No.2	SPF	
H - G	2x4	DRY	No.2	SPF	
F - C	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
ALL WEBS	2x4	DRY	No.2	SPF	
EXCEPT					
B - G	2x3	DRY	No.2	SPF	
G - D	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTV-m	MT20	5.0	6.0		
D	TMVW+p	MT20	4.0	6.0		
E	BMVW1-l	MT20	4.0	4.0		
F	BMV+p	MT20	3.0	4.0		
G	BMVWW-l	MT20	6.0	9.0	2.50	3.00
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
E	214	0	214	0
H	341	0	341	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	151	99.0	0.0	0.0	0.0	62.0	0.0
H	239	170.0	0.0	0.0	0.0	89.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS	MAX. FACTORED	VERT. LOAD	LO1	MAX	MAX. UNBRAC	MEMB.	WEBS	MAX. FACTORED
		(LBS)	(PLF)	CSI (LC)	LENGTH	FR-TO			(LBS)
FR-TO									
A-B	0 41	-91.8	-91.8	0.14 (5)	10.00	Q-E	8 0	0.00 (1)	
B-C	-62 0	-91.8	-91.8	0.12 (1)	6.25	B-G	0 53	0.01 (1)	
C-D	-51 0	-91.8	-91.8	0.01 (1)	6.25	G-D	0 154	0.03 (1)	
E-D	-197 0	0.0	0.0	0.10 (1)	7.81				
H-B	-317 0	0.0	0.0	0.03 (1)	7.81				
H-G	0 0	-18.5	-18.5	0.04 (4)	10.00				
F-G	0 13	0.0	0.0	0.01 (1)	10.00				
G-C	-138 0	0.0	0.0	0.01 (1)	7.81				
F-E	0 4	-18.5	-18.5	0.01 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 2 X 32 = 84 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.18")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.18")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.14:1.00 (A-B:5), BC=0.04:1.00 (G-H:4), WB=0.03:1.00 (D-G:1), SS=0.09:1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1687 788	1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.24 (8) (INPUT = 0.80)
JSI METAL= 0.06 (8) (INPUT = 1.00)




Structural component only
DWG# T-2007644

JOB NAME 408223	TRUSS NAME T35S	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:04:17 2020 Page 1
ID:DMCubINVR6TatFos31v61_zns11- OTvpVoXB8UMQAH_S76W2dVdRQGSEmC7KGanzMEMS

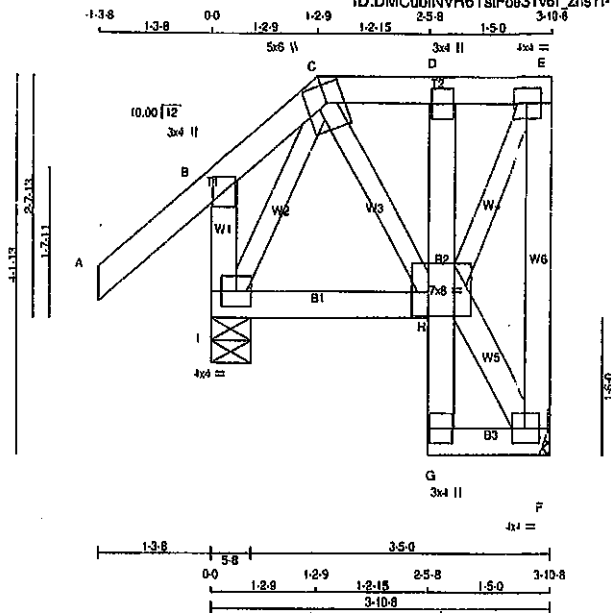

Scale = 1/2" = 1'-0"

LUMBER					DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER			
A - C	2x4	DRY	No.2	SPF		
C - E	2x4	DRY	No.2	SPF		
F - E	2x4	DRY	No.2	SPF		
I - B	2x4	DRY	No.2	SPF		
I - H	2x4	DRY	No.2	SPF		
G - D	2x4	DRY	No.2	SPF		
G - F	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						
H - F	2x4	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

PLATES (table in inches)					X	
JT TYPE	PLATES	W	LEN	Y		
B	TMV-p	MT20	3.0	4.0		
C	TTWW+m	MT20	5.0	8.0	2.50	2.25
D	TMV-p	MT20	3.0	4.0		
E	TMVW-t	MT20	4.0	4.0		
F	BMVW-t	MT20	4.0	4.0		
G	BMV-p	MT20	3.0	4.0		
H	BVMWVW-t	MT20	7.0	8.0	3.25	2.25
I	BMVW-t	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
F	191	0	191	0	0	MECHANICAL			
I	363	0	363	0	0	5-8	5-8		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	135	88 -13	0 0	0 0	0 0	49 0	0 0
I	254	183 0	0 0	0 0	0 0	72 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 41	-91.8 -91.8	0.14 (5)	10.00	H-F	-6 0	0.00 (1)
B-C	-45 0	-91.8 -91.8	0.14 (5)	6.25	H-E	0 141	0.03 (1)
C-D	-69 0	-91.8 -91.8	0.02 (1)	6.25	C-H	0 48	0.01 (1)
D-E	-67 0	-91.8 -91.8	0.02 (1)	6.25	I-C	-98 28	0.02 (1)
F-E	-175 0	0 0	0.05 (1)	7.81			
I-B	-255 0	0 0	0.03 (1)	7.81			
I-H	-13 45	-18.5 -18.5	0.04 (4)	6.25			
G-H	0 13	0 0	0.01 (1)	10.00			
H-D	-135 0	0 0	0.01 (1)	7.81			
G-F	0 4	-18.5 -18.5	0.01 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 2 X 29 = 57 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOY CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

15% OF 31.3 P.S.F. Q.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.14/1.00 (A-B:5), BC=0.04/1.00 (H-I:4), WB=0.02/1.00 (E-H:1), SS=0.09/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)
MT20	818	354 1867 788 1867 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.18 (E) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007645



DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
DESCR.	FACTORED GROSS REACTION			MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQD BRG	
SPF	JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	HEEL
SPF	B	582	0	582	0	0	5-8	5-8	2x4 L
SPF	O	582	0	582	0	0	5-8	5-8	2x4 R

UNFACTORED REACTIONS							
1ST CASE	MAX.-MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	409	282 0	0 0	0 0	0 0	127 0	0 0
D	409	282 0	0 0	0 0	0 0	127 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B. D.

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: 14)

CHORDS				WEBBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LCL (L)	MAX. UNBRAC LCL (L)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LCL (L)
FR-TO		FROM TO		LENGTH	FR-TO		
A-B	0 23	-91.8	-91.8	0.12 (1)	10.00	F-C	0 170
B-H	-539 0	-91.8	-91.8	0.04 (1)	8.25	G-H	-158 3
H-C	-525 0	-91.8	-91.8	0.15 (1)	8.25	I-J	-158 3
C-J	-525 0	-91.8	-91.8	0.15 (1)	8.25		
J-D	-539 0	-91.8	-91.8	0.04 (1)	6.25		
D-E	0 23	-91.8	-91.8	0.12 (1)	10.00		
B-G	0 465	-18.5	-18.5	0.21 (1)	10.00		
G-F	0 465	-18.5	-18.5	0.21 (1)	10.00		
F-I	0 465	-18.5	-18.5	0.21 (1)	10.00		
I-O	0 465	-18.5	-18.5	0.21 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD			=	39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9.
NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF
LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.28")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.28")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.15/1.00 (G-J:1) , BC=0.21-1.00 (F-:1) ,
WB=0.04/1.00 (C-E:1) , SS=0.12/1.00 (C-f:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.12 SHEAR=1.10 TENS=1.12

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .


NAIL VALUES

PLATE	GRIP (DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	818	354	1867	788	1987	1658


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.25 (B) (INPUT = 0.90)
JSI METAL = 0.11 (B) (INPUT = 1.00)

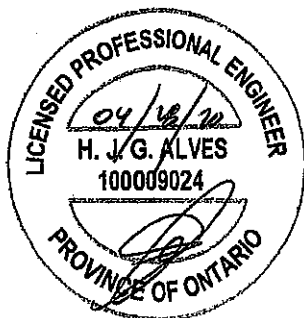

Structural component only
DWG# T-2007646

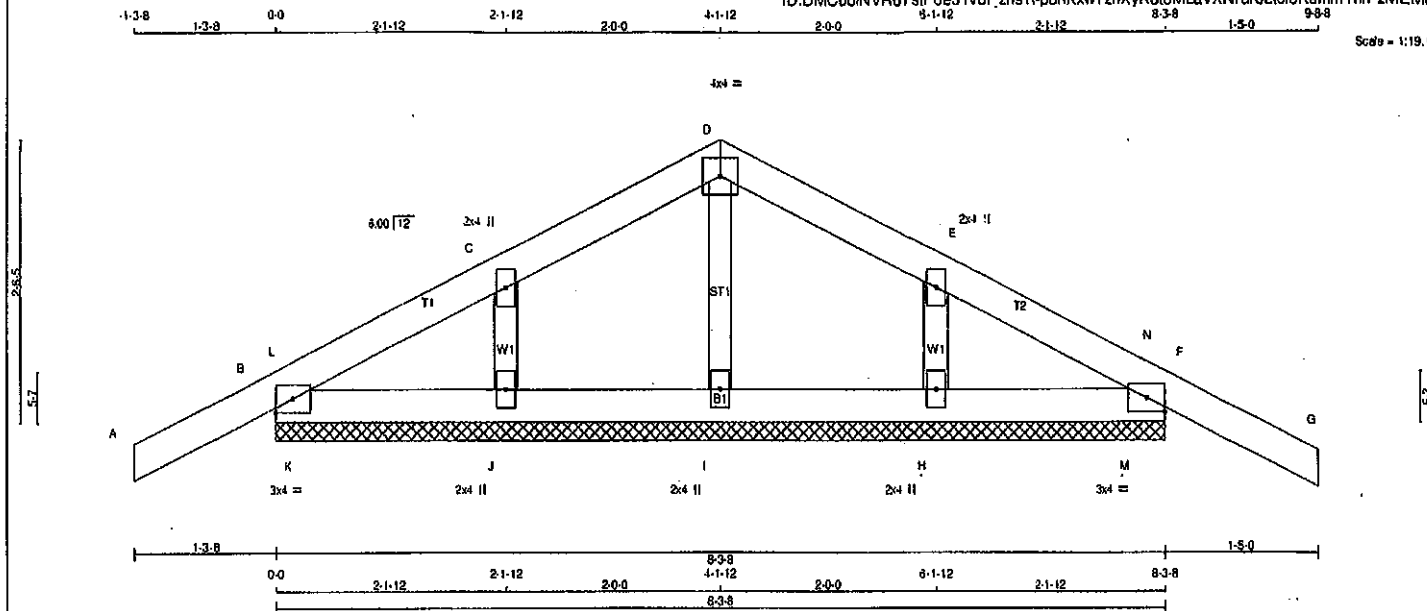

TOTAL WEIGHT = 27 IN

LUMBER				LUMBER		DESCH.
N. L. G. A. RULES						
CHORDS	SIZE					
A - D	2x4	DRY	No.2			SPF
D - G	2x4	DRY	No.2			SPF
B - F	2x4	DRY	No.2			SPF
ALL WEBS	2x3	DRY	No.2			SPF
ALL GABLE WEBS	2x3	DRY	No.2			SPF
DRY: SEASONED LUMBER						

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y
B	TMB1-I	MT20	3.0	4.0	Edge
C	TMW+w	MT20	2.0	4.0	
D	TTW-p	MT20	4.0	4.0	
E	TMW+w	MT20	2.0	4.0	
F	TMB1-I	MT20	3.0	4.0	Edge
H, I, J					
H	BMW1+w	MT20	2.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BOILING BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			WEBB					
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		LENGTH	FR-TO			
A-B	0 23	-91.8	-91.8 0.12 (1)	10.00	I-D	-115 0	0.02 (1)	
B-L	-91 0	-91.8	-91.8 0.01 (4)	8.25	J-C	-216 0	0.03 (4)	
C-D	-39 0	-91.8	-91.8 0.06 (1)	8.25	H-E	-216 0	0.03 (1)	
C-E	-45 0	-91.8	-91.8 0.06 (1)	8.25	K-L	-52 7	0.00 (1)	
D-E	-45 0	-91.8	-91.8 0.06 (1)	8.25	M-N	-52 7	0.00 (1)	
E-N	-39 0	-91.8	-91.8 0.06 (1)	8.25				
N-F	-91 0	-91.8	-91.8 0.01 (4)	8.25				
F-G	0 25	-91.8	-91.8 0.14 (1)	10.00				
B-K	0 44	-18.5	-18.5 0.03 (1)	10.00				
K-J	0 44	-18.5	-18.5 0.03 (1)	10.00				
J-I	0 32	-18.5	-18.5 0.02 (1)	10.00				
I-H	0 32	-18.5	-18.5 0.02 (1)	10.00				
H-M	0 44	-18.5	-18.5 0.03 (1)	10.00				
M-F	0 44	-18.5	-18.5 0.03 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT	CH.	LL	0.0	PSF
-----	-----	----	-----	-----

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018 , OBC 2012 , ABC 2019

• PART 9 OF OBC 2012 (2019 AMENDMENT)

- CSA 088-09, CSA 088-14

- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF
LIVE LOAD

CSI: TC=0.14/1.00 (F-G:1) , BC=0.03/1.00 (H-M:1) ,
WB=0.03/1.00 (E-H:1) , SS=0.10/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

```
JSI GRIP= 0.21 (B) (INPUT = 0.90 )
JSI METAL= 0.09 (C) (INPUT = 1.00 )
```




Structural component only
DWG# T-2007621

JOB NAME 408223	TRUSS NAME T37	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:19 2020 Page 1
ID:DMCubINVR6TstFos31v6L_zns11-xPbIEBqjK4IUR781abA7yUR47k172RpNjzMEMQ

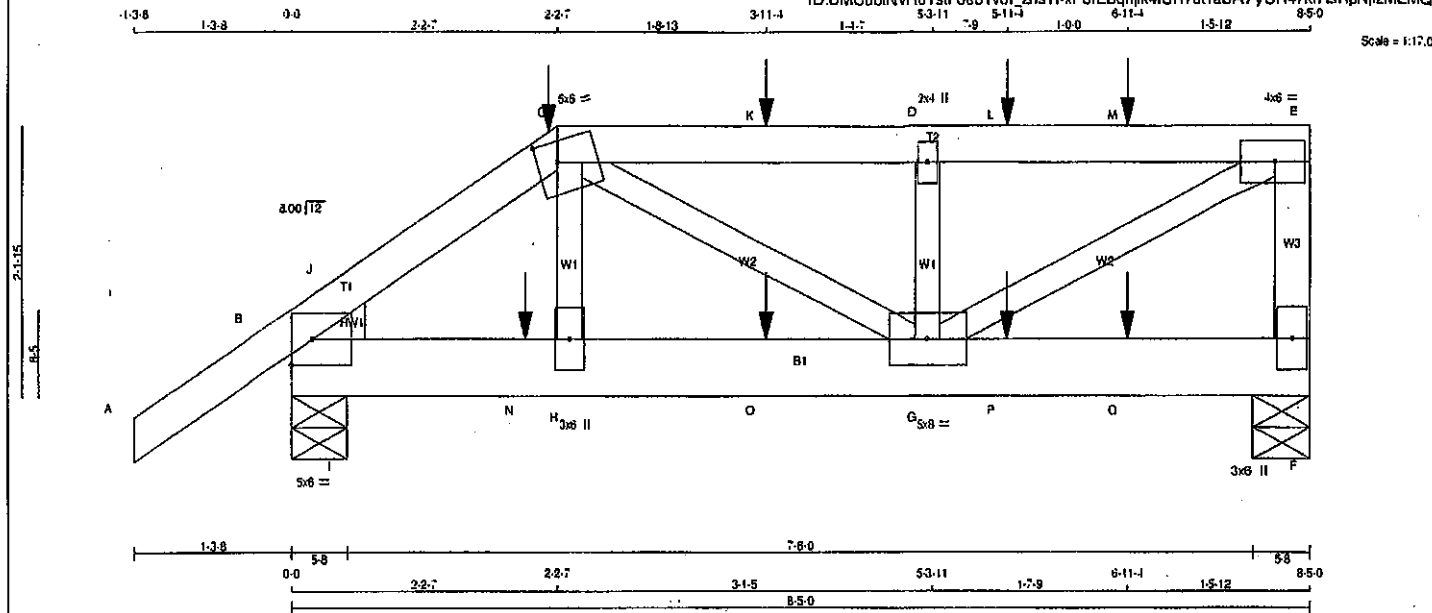

TOTAL WEIGHT = 37 k (M)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
B - F	2x6	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TM8H1-I	MT20	5.0	6.0		Edge
C	TTWW-m	MT20	5.0	6.0	2.00	2.00
D	TMVW-w	MT20	2.0	4.0		
E	BMVW-I	MT20	4.0	6.0		
F	BMV1+p	MT20	3.0	6.0		
G	BMVWW-I	MT20	5.0	6.0		
H	BMVW-w	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	HEEL WEDGE
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
F	760	0	760	0	0
B	823	0	823	0	0

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	537	352.0	0.0	0.0	0.0	185.0	0.0
B	580	392.0	0.0	0.0	0.0	188.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)	MAX. FACTORED VERT. LOAD (LC3)	MAX. FACTORED VERT. LOAD (LC4)	MAX. FACTORED VERT. LOAD (LC5)	MAX. FACTORED VERT. LOAD (LC6)	MAX. FACTORED VERT. LOAD (LC7)	MAX. FACTORED VERT. LOAD (LC8)	MAX. FACTORED VERT. LOAD (LC9)	MAX. FACTORED VERT. LOAD (LC10)
MEMB.	FR-TO	FROM	TO	FROM	TO	FROM	TO	FROM	TO	FROM	TO	FROM
A-B	-0.28	-91.8	-91.8	0.13 (1)	10.00	H-C	0.73	0.02 (4)				
B-J	-1068.0	-91.8	-91.8	0.08 (1)	5.99	C-G	0.252	0.06 (1)				
J-C	-880.0	-91.8	-91.8	0.08 (1)	8.25	G-D	-528.0	0.09 (1)				
C-K	-923.0	-91.8	-91.8	0.24 (1)	6.09	G-E	0.1082	0.26 (1)				
K-D	-923.0	-91.8	-91.8	0.24 (1)	6.09	I-J	0.207	0.00 (1)				
D-L	-924.0	-91.8	-91.8	0.24 (1)	6.09							
L-M	-924.0	-91.8	-91.8	0.24 (1)	6.09							
M-E	-924.0	-91.8	-91.8	0.24 (1)	6.09							
F-E	-882.0	0.0	0.0	0.08 (1)	7.81							
B-I	0.701	-18.5	-18.5	0.14 (1)	10.00							
I-N	0.701	-18.5	-18.5	0.14 (1)	10.00							
N-H	0.701	-18.5	-18.5	0.14 (1)	10.00							
H-O	0.705	-18.5	-18.5	0.15 (1)	10.00							
O-G	0.705	-18.5	-18.5	0.15 (1)	10.00							
G-P	0.0	-18.5	-18.5	0.07 (1)	10.00							
P-O	0.0	-18.5	-18.5	0.07 (1)	10.00							
Q-F	0.0	-18.5	-18.5	0.07 (1)	10.00							

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	2-2.7	-88	-88	---	FRONT	VERT	TOTAL	C1
K	3-11.4	-83	-83	---	FRONT	VERT	TOTAL	C1
L	5-11.4	-83	-83	---	FRONT	VERT	TOTAL	C1
M	6-11.4	-83	-83	---	FRONT	VERT	TOTAL	C1
N	1-11.4	-48	-48	---	FRONT	VERT	TOTAL	C1
O	3-11.4	-48	-48	---	FRONT	VERT	TOTAL	C1
P	5-11.4	-48	-48	---	FRONT	VERT	TOTAL	C1
Q	6-11.4	-48	-48	---	FRONT	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.28")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.28")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.24/1.00 (D/E:1), BC=0.15/1.00 (G/H:1), WB=0.28/1.00 (E/G:1), SSI=0.25/1.00 (D/E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 615 354 1667 788 1987 1556

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.61 (E) (INPUT = 0.90)
JSI METAL= 0.24 (E) (INPUT = 1.00)




Structural component only
DWG# T-2007647

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	G39	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 28 2019 Mitek Industries, Inc. Tue Apr 28 10:03:50 2020 Page 1

ID:DMCubINVR8TstFoe31v6l zns11-HqL8GTbYr4Bq0QZvH0mw2R1aiDRRBmn_QH-LBrzMEM

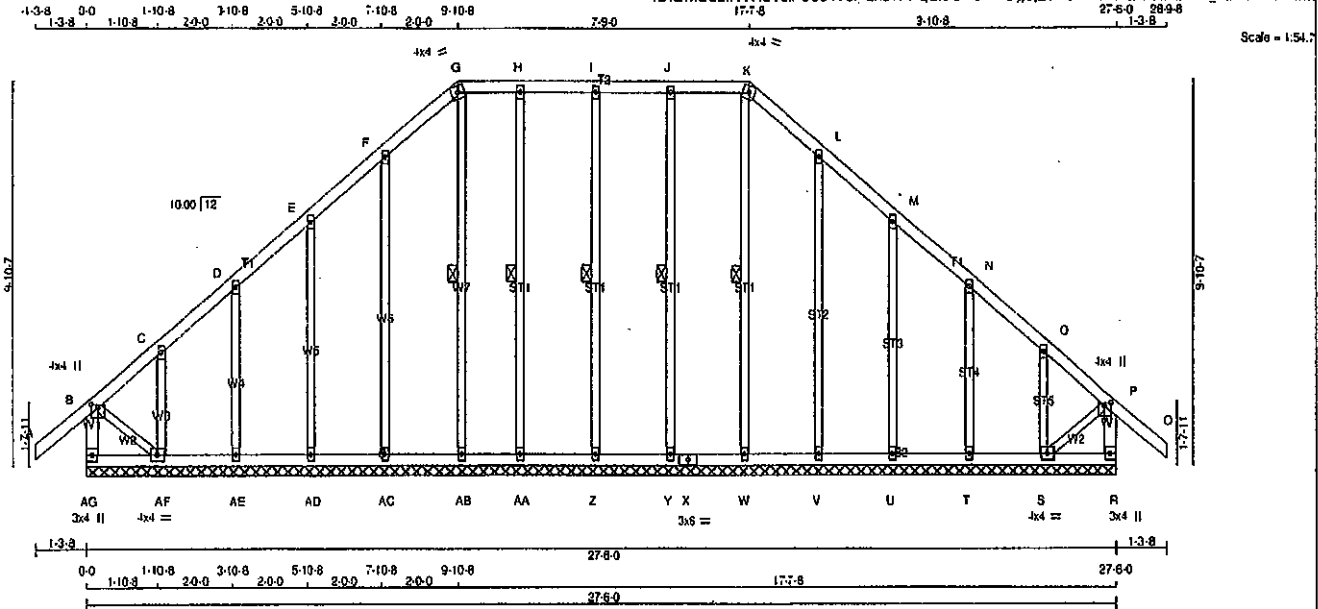

TOTAL WEIGHT = 2 X 152 = 303 lb (M)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
AG - B	2x4	DRY	No.2	SPF	
A - G	2x4	DRY	No.2	SPF	
G - K	2x4	DRY	No.2	SPF	
K - Q	2x4	DRY	No.2	SPF	
R - P	2x4	DRY	No.2	SPF	
AG - X	2x4	DRY	No.2	SPF	
X - R	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
ALL GABLE WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					
GABLE STUDS SPACED AT	2'-0" O.C.				

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B TMW+p	MT20	4.0	4.0	1.00	2.00	
C, D, E, F, H, I, J, L, M, N, O						
C TMW+w	MT20	2.0	4.0			
G TTW-m	MT20	4.0	4.0			
K TTW-m	MT20	4.0	4.0			
P TMW+p	MT20	4.0	4.0	1.00	2.00	
R BMV1+p	MT20	3.0	4.0			
S BMWV1-l	MT20	4.0	4.0			
T, U, V, W, Y, Z, AA, AB, AC, AD, AE						
T BMW1+w	MT20	2.0	4.0			
X BS-l	MT20	3.0	6.0			
AF BMWV1-l	MT20	-1.0	4.0			
AG BMV1+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF K-W, J-Y, I-Z, H-AA, G-AB.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)	MAX UNBRAC LENGTH	MEMB.	FACTORED FORCE (LBS)	MAX LC1 (LC)	
FR-TO		FROM TO			FR-TO			
AG-B	-292 0	0.0	0.0	0.03 (1)	7.81	W-K	-140 0	0.09 (1)
A-B	0 41	-91.8	-91.8	0.13 (1)	10.00	Y-J	-210 0	0.14 (1)
B-C	-60 0	-91.8	-91.8	0.12 (1)	6.25	Z-I	-181 0	0.12 (1)
C-D	-23 0	-91.8	-91.8	0.05 (1)	6.25	AA-H	-182 0	0.12 (1)
D-E	-26 0	-91.8	-91.8	0.05 (1)	6.25	V-L	-203 0	0.27 (1)
E-F	-19 0	-91.8	-91.8	0.05 (1)	6.25	U-M	-175 0	0.13 (1)
F-G	-29 0	-91.8	-91.8	0.05 (1)	6.25	T-N	-192 0	0.07 (1)
G-H	-12 0	-91.8	-91.8	0.04 (1)	6.25	S-O	-126 0	0.02 (1)
H-I	-12 0	-91.8	-91.8	0.04 (1)	6.25	AB-G	-121 0	0.08 (1)
I-J	-12 0	-91.8	-91.8	0.05 (1)	6.25	AC-F	-202 0	0.27 (1)
J-K	-12 0	-91.8	-91.8	0.05 (1)	6.25	AD-E	-176 0	0.13 (1)
K-L	-30 0	-91.8	-91.8	0.05 (1)	6.25	AE-D	-192 0	0.07 (1)
L-M	-19 0	-91.8	-91.8	0.05 (1)	6.25	AF-C	-126 0	0.02 (1)
M-N	-26 0	-91.8	-91.8	0.05 (1)	6.25	BA-F	0 32	0.01 (1)
N-O	-24 0	-91.8	-91.8	0.05 (1)	6.25	S-P	0 32	0.01 (1)
O-P	-60 0	-91.8	-91.8	0.12 (1)	6.25			
P-Q	0 41	-91.8	-91.8	0.13 (1)	10.00			
R-P	-293 0	0.0	0.0	0.03 (1)	7.81			
AG-AF	0 0	-18.5	-18.5	0.02 (4)	10.00			
AF-AE	0 23	-18.5	-18.5	0.02 (4)	10.00			
AE-AD	0 19	-18.5	-18.5	0.02 (4)	10.00			
AD-AC	0 16	-18.5	-18.5	0.02 (4)	10.00			
AC-AB	0 14	-18.5	-18.5	0.02 (4)	10.00			
AB-AA	0 12	-18.5	-18.5	0.01 (4)	10.00			
AA-Z	0 12	-18.5	-18.5	0.02 (4)	10.00			
Z-Y	0 12	-18.5	-18.5	0.02 (4)	10.00			
Y-X	0 12	-18.5	-18.5	0.02 (4)	10.00			
X-W	0 12	-18.5	-18.5	0.02 (4)	10.00			
W-V	0 14	-18.5	-18.5	0.02 (4)	10.00			
V-U	0 16	-18.5	-18.5	0.02 (4)	10.00			
U-T	0 19	-18.5	-18.5	0.02 (4)	10.00			
T-S	0 23	-18.5	-18.5	0.02 (4)	10.00			
S-R	0 0	-18.5	-18.5	0.02 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN./G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8:00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.13/1.00 (P-Q:1), BC=0.02/1.00 (S-T:4), W8=0.27/1.00 (L-V:1), SSI=0.09/1.00 (J-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 768

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.62 (K) INPUT = 0.90
JSI METAL= 0.11 (L) INPUT = 1.00



Structural component only
DWG# T-2007622


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	T40	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:19:57 2020 Page 1

ID:DMCubINVR6TsiFos31v6l_zns11-TsGG6wA9pyw_Bd8P2IsKcz_APYAIVTa7LN10dizME7m

1-3.8 0-0 5-10-8 5-10-8 5-10-14 11-8-6 5-8-10 17-7-0 19-2-12 4-1-14 23-4-10 5-10-14 29-3-8 5-10-8 35-2-0 35-8-8 1-3-8 Scale = 1:57.6

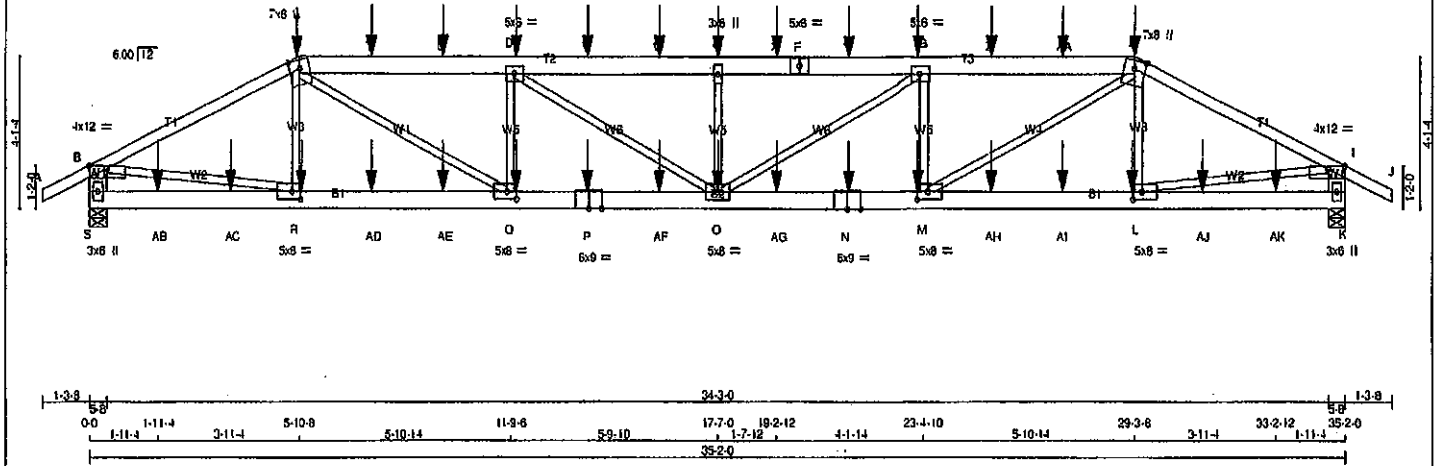

TOTAL WEIGHT = 2 X 169 = 338 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - F	2x6	DRY	No.2	SPF		
F - H	2x6	DRY	No.2	SPF		
H - J	2x4	DRY	No.2	SPF		
S - B	2x6	DRY	No.2	SPF		
K - I	2x6	DRY	No.2	SPF		
S - P	2x6	DRY	1850F 1.5E	SPF		
P - N	2x6	DRY	1850F 1.5E	SPF		
N - K	2x6	DRY	1850F 1.5E	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C 1 12	SIDE(61.0)	
H-J 1 12	SIDE(61.0)	
C-F 2 12	SIDE(183.1)	
F-H 2 12	SIDE(183.1)	
S-B 2 12	TOP	
K-I 2 12	TOP	
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S-P 2 12	SIDE(183.1)	
P-N 2 12	SIDE(183.1)	
N-K 2 12	SIDE(183.1)	
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1 6		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS, AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD.
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UPLIFT	IN-SX
S	3323 0	3323 0	5-8	5-8
K	3323 0	3323 0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LOASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	2350	1539 0	0-0	0-0	0-0	0-0	811 0	0-0
K	2350	1539 0	0-0	0-0	0-0	0-0	811 0	0-0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.87 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED	FACTORED	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD LC1	MAX	MEMB.	FORCE	MAX	MAX
(LBS)	(PLF)	CS1(LC)	UNBRAC	(LBS)	(LBS)	CS1(LC)	
FR-TO	FROM TO	LENGTH	FR-TO				
A-B	0 28	-91.8 -91.8 0.07 (1)	10.00	R-C	-413 20	0.05 (1)	
B-C	-5068 0	-91.8 -91.8 0.52 (1)	3.87	C-Q	0 3193	0.40 (1)	
C-T	-7284 0	-91.8 -91.8 0.27 (1)	4.26	Q-D	-1500 0	0.18 (1)	
T-U	-7284 0	-91.8 -91.8 0.27 (1)	4.26	D-O	0 946	0.12 (1)	
U-D	-7284 0	-91.8 -91.8 0.27 (1)	4.26	O-E	-830 0	0.10 (1)	
D-V	-8084 0	-91.8 -91.8 0.27 (1)	4.08	O-G	0 946	0.12 (1)	
V-W	-8084 0	-91.8 -91.8 0.27 (1)	4.08	M-G	-1500 0	0.18 (1)	
W-E	-8084 0	-91.8 -91.8 0.27 (1)	4.08	M-H	0 3193	0.40 (1)	
E-X	-8084 0	-91.8 -91.8 0.27 (1)	4.08	L-H	-413 20	0.05 (1)	
X-F	-8084 0	-91.8 -91.8 0.27 (1)	4.08	B-R	0 4582	0.57 (1)	
F-Y	-8084 0	-91.8 -91.8 0.27 (1)	4.08	L-I	0 4582	0.57 (1)	
Y-G	-8084 0	-91.8 -91.8 0.27 (1)	4.08				
G-Z	-7284 0	-91.8 -91.8 0.27 (1)	4.26				
Z-AA	-7284 0	-91.8 -91.8 0.27 (1)	4.26				
AA-H	-7284 0	-91.8 -91.8 0.27 (1)	4.26				
H-I	-5068 0	-91.8 -91.8 0.52 (1)	3.87				
I-J	0 28	-91.8 -91.8 0.07 (1)	10.00				
S-B	-3248 0	0.0 0.0 0.11 (1)	7.69				
K-I	-3248 0	0.0 0.0 0.11 (1)	7.69				

S-AB	0 0	-18.5 -18.5 0.04 (4)	10.00
AB-AC	0 0	-18.5 -18.5 0.04 (4)	10.00
AC-R	0 0	-18.5 -18.5 0.04 (4)	10.00
R-AD	0 4553	-18.5 -18.5 0.22 (1)	10.00
AD-AE	0 4553	-18.5 -18.5 0.22 (1)	10.00
AE-O	0 4553	-18.5 -18.5 0.22 (1)	10.00
O-P	0 7283	-18.5 -18.5 0.34 (1)	10.00
P-AF	0 7283	-18.5 -18.5 0.34 (1)	10.00
AF-O	0 7283	-18.5 -18.5 0.34 (1)	10.00
O-AG	0 7283	-18.5 -18.5 0.34 (1)	10.00
AG-N	0 7283	-18.5 -18.5 0.34 (1)	10.00
N-M	0 7283	-18.5 -18.5 0.34 (1)	10.00
MAH	0 4553	-18.5 -18.5 0.22 (1)	10.00
AH-AI	0 4553	-18.5 -18.5 0.22 (1)	10.00
AI-L	0 4553	-18.5 -18.5 0.22 (1)	10.00
L-AJ	0 0	-18.5 -18.5 0.04 (4)	10.00
AJ-AK	0 0	-18.5 -18.5 0.04 (4)	10.00
AK-K	0 0	-18.5 -18.5 0.04 (4)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-429	-429	FRONT	VERT	TOTAL	---	C1
O	11-11-4	-110	-110	FRONT	VERT	TOTAL	---	C1

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2015, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

.55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.21')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.39')

CS1: TC=0.52(1.00) (R-C:1), BC=0.34(1.00) (O-C:1), WB=0.57(1.00) (B-R:1), SSI=0.15(1.00) (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(OR)Y SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.56 (R) (INPUT = 0.90)
JSI METAL= 0.56 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007660 1/2

CONTINUED ON PAGE 2

JOB NAME 408224	TRUSS NAME T40	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:19:57 2020 Page 2	
				ID:DMCubINVR6TsIFoe31v6L zns1I-TsGG5wA8pyw Bd8P2IsXcz APYAVTa7LN10dlzME7m	

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	4.0	12.0	1.00	5.50
C	TTWW+m	MT20	7.0	8.0	Edge	
D	TMWV-l	MT20	5.0	6.0		
E	TMWV-w	MT20	3.0	6.0		
F	TS-l	MT20	5.0	6.0		
G	TMWV-l	MT20	5.0	6.0		
H	TTWW+m	MT20	7.0	8.0	Edge	
I	TMWV-p	MT20	4.0	12.0	1.00	5.50
K	BMV1+p	MT20	3.0	8.0		
L	BMWV-l	MT20	5.0	8.0	2.50	3.00
M	BMWV-l	MT20	5.0	8.0	2.50	3.25
N	BS-l	MT20	6.0	9.0		
O	BMWVW-l	MT20	5.0	8.0		
P	BS-l	MT20	6.0	9.0		
Q	BMWV-l	MT20	5.0	8.0	2.50	3.25
R	BMWV-l	MT20	5.0	8.0	2.50	3.00
S	BMV1+p	MT20	3.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	17-7-0	-110	-110	---	FRONT	VERT	TOTAL	---	C1
G	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	29-3-8	-429	-429	---	FRONT	VERT	TOTAL	---	C1
L	29-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
M	23-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
N	21-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
O	17-7-0	-28	-28	---	FRONT	VERT	TOTAL	---	C1
P	13-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
Q	11-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	19-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	21-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	1-11-4	-25	-25	---	FRONT	VERT	TOTAL	---	C1
AC	3-11-4	-25	-25	---	FRONT	VERT	TOTAL	---	C1
AD	7-11-4	-25	-25	---	FRONT	VERT	TOTAL	---	C1
AE	9-11-4	-25	-25	---	FRONT	VERT	TOTAL	---	C1
AF	15-11-4	-25	-25	---	FRONT	VERT	TOTAL	---	C1
AG	19-2-12	-25	-25	---	FRONT	VERT	TOTAL	---	C1
AH	25-2-12	-25	-25	---	FRONT	VERT	TOTAL	---	C1
AI	27-2-12	-25	-25	---	FRONT	VERT	TOTAL	---	C1
AJ	31-2-12	-25	-25	---	FRONT	VERT	TOTAL	---	C1
AK	33-2-12	-25	-25	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.





Structural component only
DWG# T-2007680

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T40Z	1	2	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:58 2020 Page 1

ID:DMCubINVR6Ts1Foe31v6I zns11-x2qeJGBaF2rnpjbcaNm9BWHeyQ8EpcGa1mZakzME7I

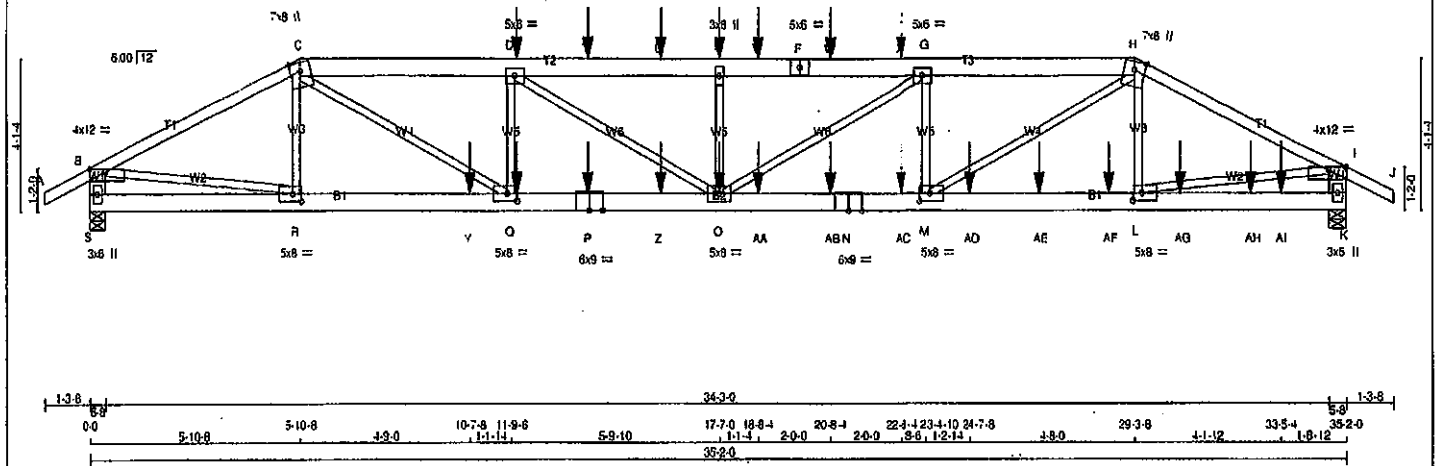

TOTAL WEIGHT = 2 X 169 = 338 LB

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - F	2x6	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - J	2x4	DRY	No.2	SPF	
S - B	2x6	DRY	No.2	SPF	
K - I	2x6	DRY	No.2	SPF	
S - P	2x6	DRY	1650F 1.5E	SPF	
P - N	2x6	DRY	1650F 1.5E	SPF	
N - K	2x6	DRY	1650F 1.5E	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.


DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	TOP
H - J	12	TOP
C - F	12	SIDE (183.1)
F - H	12	SIDE (0.0)
S - B	12	TOP
K - I	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S - P	12	SIDE (183.1)
P - N	12	SIDE (183.1)
N - K	12	SIDE (0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

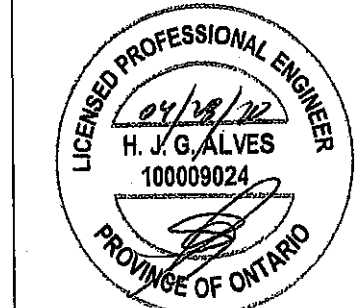

Structural component only
DWG# T-2007661

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UPLIFT
S	4161	0	4161	0
K	5042	0	5042	0

UNFACTORED REACTIONS	1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW
S	2938	1985
K	3582	2409
	LIVE	PERM. LIVE
JT	0	0
S	0	0
K	0	0
	WIND	DEAD
JT	970	0
S	0	0
K	1143	0
	SOIL	
JT	0	0
S	0	0
K	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.95 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING	TOTAL LOAD CASES: (4)
CHORDS	FACTORED
MEMB.	FORCE (LBS)
FR-TO	FROM TO
A-B	0 28
B-C	-6650 0
C-D	-10735 0
D-T	-12119 0
T-U	-12119 0
U-E	-12119 0
E-V	-12119 0
V-F	-12119 0
F-W	-12119 0
W-X	-12119 0
X-G	-12119 0
G-H	-12159 0
H-I	-8042 0
I-J	0 28
S-B	-4141 0
K-I	-4926 0
S-R	0 0
R-Y	0 5974
Y-O	0 5974
O-P	0 10734
P-Z	0 10734
Z-O	0 10734
O-AA	0 12169
AA-AB	0 12169
AB-N	0 12159
N-AC	0 12159
AC-M	0 12159
M-AD	0 7208
AD-AE	0 7208
AE-AF	0 7208
AF-L	0 7208
L-AG	0 0
AG-AH	0 0
AH-AI	0 0
AI-K	0 0
FR-TO	FROM TO
A-B	-91.8 -91.8 0.07 (1)
B-C	-91.8 -91.8 0.66 (1)
C-D	-91.8 -91.8 0.33 (1)
D-T	-91.8 -91.8 0.40 (1)
T-U	-91.8 -91.8 0.40 (1)
U-E	-91.8 -91.8 0.40 (1)
E-V	-91.8 -91.8 0.45 (1)
V-F	-91.8 -91.8 0.45 (1)
F-W	-91.8 -91.8 0.45 (1)
W-X	-91.8 -91.8 0.45 (1)
X-G	-91.8 -91.8 0.45 (1)
G-H	-91.8 -91.8 0.39 (1)
H-I	-91.8 -91.8 0.81 (1)
I-J	-91.8 -91.8 0.07 (1)
S-B	0.0 0.0 0.15 (1)
K-I	0.0 0.0 0.17 (1)
S-R	-18.5 -18.5 0.05 (1)
R-Y	-18.5 -18.5 0.44 (1)
Y-O	-18.5 -18.5 0.44 (1)
O-P	-18.5 -18.5 0.54 (1)
P-Z	-18.5 -18.5 0.54 (1)
Z-O	-18.5 -18.5 0.54 (1)
O-AA	-18.5 -18.5 0.71 (1)
AA-AB	-18.5 -18.5 0.71 (1)
AB-N	-18.5 -18.5 0.71 (1)
N-AC	-18.5 -18.5 0.71 (1)
AC-M	-18.5 -18.5 0.71 (1)
M-AD	-18.5 -18.5 0.69 (1)
AD-AE	-18.5 -18.5 0.69 (1)
AE-AF	-18.5 -18.5 0.69 (1)
AF-L	-18.5 -18.5 0.69 (1)
L-AG	-18.5 -18.5 0.16 (1)
AG-AH	-18.5 -18.5 0.16 (1)
AH-AI	-18.5 -18.5 0.16 (1)
AI-K	-18.5 -18.5 0.16 (1)
FR-TO	FROM TO
A-B	-11.1 -11.4
E	17.7 -0
O	17.7 -0
P	13.1 -4
LOC	LC1
D	-110
E	-110
O	-26
P	-26
FACE	DIR.
D	BACK
E	BACK
O	BACK
P	BACK
TYPE	HEEL
D	TOTAL
E	TOTAL
O	TOTAL
P	TOTAL
CONN.	
D	C1
E	C1
O	C1
P	C1

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.0:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/999 (0.32")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/716 (0.59")
CSI: TC=0.81-1.00 (H-I), BC=0.71-1.00 (M-O), I, WB=0.90-1.00 (I-L), SS=0.64-1.00 (L-M:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (RY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1857 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (R) (INPUT = 0.90)
JSI METAL = 0.93 (P) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T40Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Tamarack Roof Truss, Burlington

Version 3.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:19:58 2020 Page 2

ID:DMCubINVR6TsIFoe31v8I zns11-x2qeJGBoaP2mnbcaNm9BWHeyQ8EpcGa1mZakzME7I

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	12.0	1.00	5.50
C	TTWW+m	MT20	7.0	8.0	Edge	
D	TMWW-l	MT20	5.0	6.0		
E	TMW+w	MT20	3.0	6.0		
F	TS-l	MT20	5.0	6.0		
G	TMWW-l	MT20	5.0	6.0		
H	TTWW+m	MT20	7.0	8.0	Edge	
I	TMVW-p	MT20	4.0	12.0	1.00	5.50
K	BMV1+p	MT20	3.0	6.0		
L	BMWW-l	MT20	5.0	8.0	2.50	3.00
M	BMWW-l	MT20	5.0	8.0	2.50	3.25
N	BS-l	MT20	6.0	9.0		
O	BMWWW-l	MT20	5.0	8.0		
P	BS-l	MT20	6.0	9.0		
Q	BMWW-l	MT20	5.0	8.0	2.50	3.25
R	BMWW-l	MT20	5.0	8.0	2.50	3.00
S	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
Q	11-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
T	13-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
U	15-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	18-8-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
W	20-8-4	-159	-159	---	BACK	VERT	TOTAL	---	C1
X	22-8-4	-159	-159	---	BACK	VERT	TOTAL	---	C1
Y	10-7-8	-1171	-1171	---	BACK	VERT	TOTAL	---	C1
Z	15-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AA	18-8-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AB	20-8-4	-32	-32	---	BACK	VERT	TOTAL	---	C1
AC	22-8-4	-32	-32	---	BACK	VERT	TOTAL	---	C1
AD	24-7-8	-2237	-2237	---	BACK	VERT	TOTAL	---	C1
AE	28-8-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AF	28-8-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AG	30-8-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AH	32-8-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AI	33-5-4	-121	-121	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

11 C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007661 *72*

Tamarack Roof Truss, Burlington


Version 8.310 S Oct 28 2019 MTEK Industries, Inc. Tue Apr 28 10:19:59 2020 Page 1

ID:DMCubINVR6TstFoe31v6l zns1t-PFOQWwCQLZAIQxloAHu?hO3QDMnRzl?PphW7IAzME7k

1-3-8 0-0 4-0-8 2-10-0 14-4-9 20-9-7 27-3-8 31-1-8 35-2-0 38-5-8

1-3-8 4-0-8 2-10-0 8-8-1 8-4-13 3-10-0 1-3-8

Scale = 1/32"

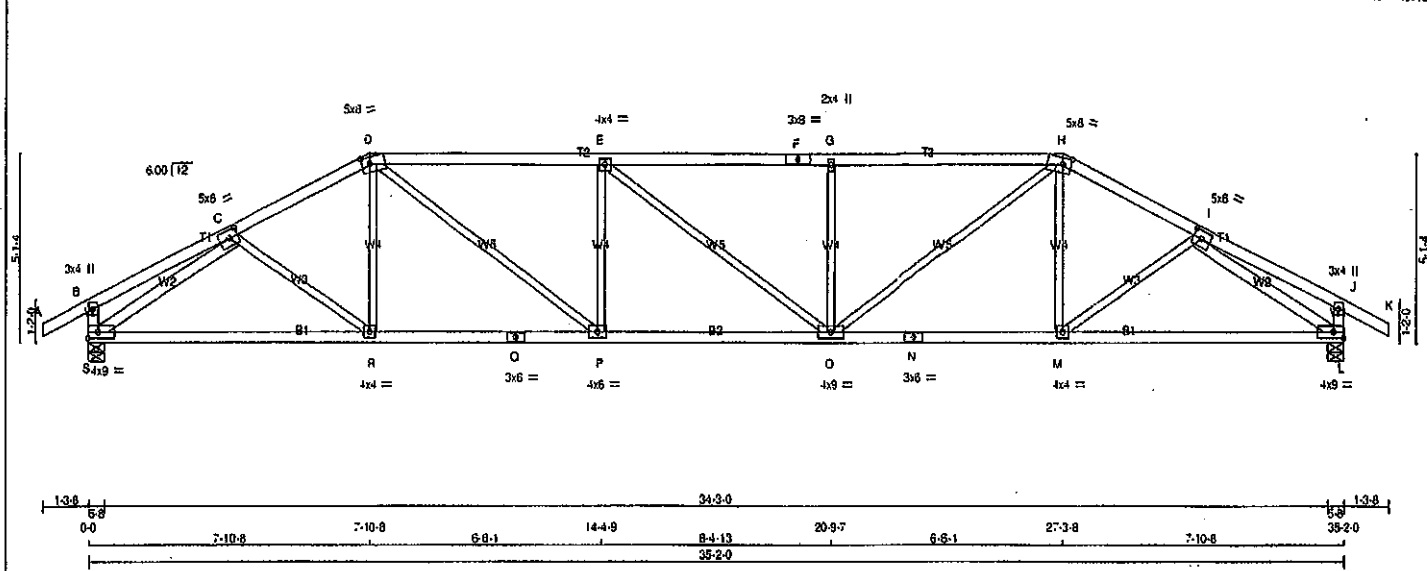

TOTAL WEIGHT = 2 X 139 = 278 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER		DESCR
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - K	2x4	DRY	No.2	SPF
S - B	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
S - Q	2x4	DRY	No.2	SPF
Q - N	2x4	DRY	No.2	SPF
N - L	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
S - C	2x4	DRY	No.2	SPF
I - L	2x4	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

DRY: SEASONED LUMBER.

PLATES (tablets in inches)						
PLATES	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-I	MT20	5.0	6.0	2.50	2.75
D	TTWV-m	MT20	5.0	6.0	2.25	2.75
E	TMVW-I	MT20	4.0	4.0		
F	TS-I	MT20	3.0	6.0		
G	TMV+w	MT20	2.0	4.0		
H	TTWV-m	MT20	5.0	6.0	2.25	2.75
I	TMVW-I	MT20	5.0	6.0	2.50	2.75
J	TMV+p	MT20	3.0	4.0		
L	BMVW-I	MT20	4.0	9.0		Edge
M	BMVW-I	MT20	4.0	4.0		
N	BS-I	MT20	3.0	6.0		
O	BMVWVW-I	MT20	4.0	9.0		
P	BMVW-I	MT20	4.0	6.0		
Q	BS-I	MT20	3.0	6.0		
R	BMVW-I	MT20	4.0	4.0		
S	BMVW-I	MT20	4.0	9.0		Edge

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
FACTORED			MAXIMUM FACTORED			INPUT	REQ'D
GROSS REACTION			GROSS REACTION			BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
S	2063	0	2063	0	0	5-8	5-8
L	2063	0	2063	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SO
S	1457	969 0	0 0	0 0	0 0	-488 0	0
L	1457	969 0	0 0	0 0	0 0	-488 0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S. I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.94 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: 14)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. MAX. (LBS)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. MAX. (LBS)
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 28	-91.8	-91.8 0.12 (1)	10.00	C-R	0 93	0.03 (4)
B-C	0 16	-91.8	-91.8 0.20 (1)	10.00	R-D	0 121	0.04 (4)
C-D	-2799 0	-91.8	-91.8 0.32 (1)	3.88	D-P	0 1267	0.29 (1)
D-E	-3508 0	-91.8	-91.8 0.95 (1)	2.94	P-E	-643 0	0.25 (1)
E-F	-3507 0	-91.8	-91.8 0.93 (1)	2.94	E-O	-2 0	0.00 (1)
F-G	-3507 0	-91.8	-91.8 0.93 (1)	2.94	O-G	-643 0	0.25 (1)
G-H	-3507 0	-91.8	-91.8 0.94 (1)	2.95	O-H	0 1266	0.28 (1)
H-I	-2799 0	-91.8	-91.8 0.32 (1)	3.88	M-H	0 121	0.04 (4)
I-J	0 16	-91.8	-91.8 0.20 (1)	10.00	M-I	0 93	0.03 (4)
J-K	0 28	-91.8	-91.8 0.12 (1)	10.00	S-C	-2974 0	0.83 (1)
S-B	-270 0	0.0	0.0 0.03 (1)	7.81	I-L	-2974 0	0.83 (1)
L-J	-270 0	0.0	0.0 0.03 (1)	7.81			
S-R	0 2417	-18.5	-18.5 0.53 (1)	10.00			
R-O	0 2489	-18.5	-18.5 0.54 (1)	10.00			
Q-P	0 2489	-18.5	-18.5 0.54 (1)	10.00			
P-O	0 3509	-18.5	-18.5 0.64 (1)	10.00			
O-N	0 2489	-18.5	-18.5 0.54 (1)	10.00			
N-M	0 2489	-18.5	-18.5 0.54 (1)	10.00			
M-L	0 2417	-18.5	-18.5 0.53 (1)	10.00			

DESIGN CRITERIA:

SPECIFIED LOADS

TOP CH.	LL	=	25.6	PSI
	DL	=	6.0	PSI
BOT CH.	LL	=	0.0	PSI
	DL	=	7.4	PSI
TOTAL LOAD		=	38.0	PSI

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

165 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF
LIVE LOAD

ALLOWABLE DEFL.(LL) = L360 (1.17")
CALCULATED VERT. DEFL.(LL) = L 999 (0.21")
ALLOWABLE DEFL.(TL) = L360 (1.17")
CALCULATED VERT. DEFL.(TL) = L 999 (0.41")

CSI: TC=0.96/1.00 (D-E:1) , BC=0.64/1.00 (O-P:1)
MIR: 0.82/1.00 (I-L:1) , SEI: 0.89/1.00 (O-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.0

AUTOSOLVE HEELS OF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	616	.354	1667	.768	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (L) (INPUT = 0.90 ;
JSI METAL = 0.77 (N) (INPUT = 1.00




Structural component only
DWG# T-2007662

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T42	2	1	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 28 2019 Mtek Industries, Inc. Tue Apr 28 10:20:01 2020 Page 1
ID:DMCubINVR8Tsf0e31v6l_zns1L-LdWnxHegAQpGfSAHixTm8U9V7RFJG??En3zME7

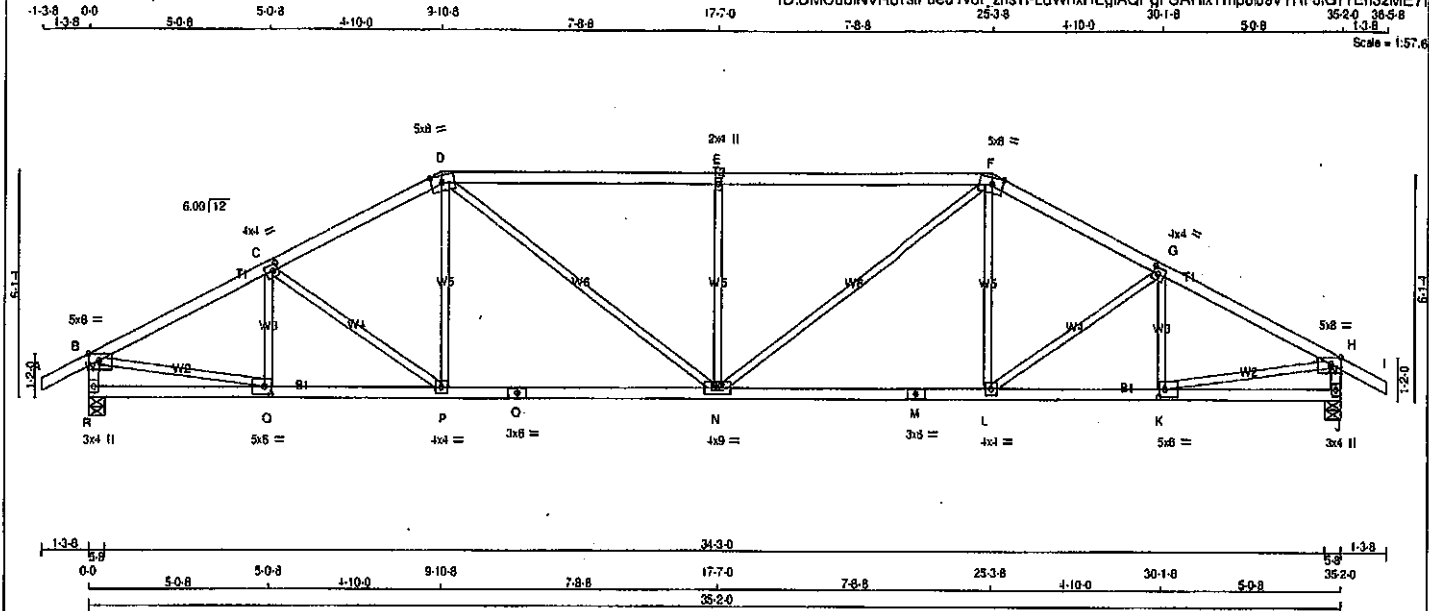

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4 DRY	No.2	SPF		
D - F	2x4 DRY	No.2	SPF		
F - I	2x4 DRY	No.2	SPF		
I - B	2x4 DRY	No.2	SPF		
B - H	2x4 DRY	No.2	SPF		
H - O	2x4 DRY	No.2	SPF		
O - M	2x4 DRY	No.2	SPF		
M - J	2x4 DRY	No.2	SPF		
ALL WEBS	2x3 DRY	No.2	SPF		
EXCEPT					
DRY: SEASONED LUMBER.					

PLATES (tablets in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	3.50
C	TMWW-I	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	8.0	2.25	3.75
E	TMW+w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	8.0	2.25	3.75
G	TMWW-I	MT20	4.0	4.0	2.00	1.75
H	TMVW-p	MT20	5.0	8.0	Edge	3.50
J	BMV1+p	MT20	3.0	4.0		
K	BMWW-I	MT20	5.0	8.0	2.50	2.00
L	BMWW-I	MT20	4.0	4.0		
M	BS-I	MT20	3.0	8.0		
N	BMWWWW-I	MT20	4.0	9.0		
O	BS-I	MT20	3.0	8.0		
P	BMWW-I	MT20	4.0	4.0		
Q	BMWW-I	MT20	5.0	8.0	2.50	2.00
R	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
BEARINGS		GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BRG	IN-SX
R	2083	0	2083	0	0	5-8	5-8	5-8	5-8
J	2083	0	2083	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST CASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
R	1457	989	0	0	0
J	1457	989	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.78 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING		TOTAL LOAD CASES: (4)	
CHORDS		FACTORED	
MEMB.	MAX. FACTORED	VERT. LOAD	MAX. MAX.
FR-TO	FORCE (LBS)	PLF	CSF (L/C)
A-B	0	28	-91.8 -91.8 0.12 (1)
B-C	-2834	0	-91.8 -91.8 0.39 (1)
C-D	-2887	0	-91.8 -91.8 0.37 (1)
D-E	-3080	0	-91.8 -91.8 0.97 (1)
E-F	-3080	0	-91.8 -91.8 0.97 (1)
F-G	-2687	0	-91.8 -91.8 0.37 (1)
G-H	-2684	0	-91.8 -91.8 0.39 (1)
H-I	0	28	-91.8 -91.8 0.12 (1)
I-J	-2018	0	0.0 0.0 0.20 (1)
J-H	-2018	0	0.0 0.0 0.20 (1)
R-Q	0	0	-18.5 -18.5 0.10 (4)
Q-P	0	2555	-18.5 -18.5 0.51 (1)
P-O	0	2388	-18.5 -18.5 0.49 (1)
O-N	0	2388	-18.5 -18.5 0.49 (1)
N-M	0	2388	-18.5 -18.5 0.49 (1)
M-L	0	2388	-18.5 -18.5 0.49 (1)
L-K	0	2555	-18.5 -18.5 0.51 (1)
K-J	0	0	-18.5 -18.5 0.10 (4)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.17")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.34")

CSF: TC=0.97 1.00 (D-E:1) , SC=0.51 1.00 (P-Q:1) ,
WB=0.58 1.00 (B-C:1) , SS=0.34 1.00 (D-E:1)

DDL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.87 (F) ; INPUT = 0.90 ;
JSI METAL = 0.75 (M) ; INPUT = 1.00 ;



Structural component only
DWG# T-2007663

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DWG NO.
408224	T43	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 26 10:20:02 2020 Page 1
 ID:DMCubINVR6TstFoe31v6l_zns11-qp498dElaUYGHO1NrQSiJth7BZrVAIQsVlknJVzME7h
 1-3-8 0-0 4-0-8 5-10-0 11-10-8 5-8-8 17-7-0 23-3-8 5-10-0 29-1-8 35-2-0 36-5-8
 1-3-8 0-0 4-0-8 5-10-0 11-10-8 5-8-8 17-7-0 23-3-8 5-10-0 29-1-8 35-2-0 36-5-8
 Scale = 1:57.6

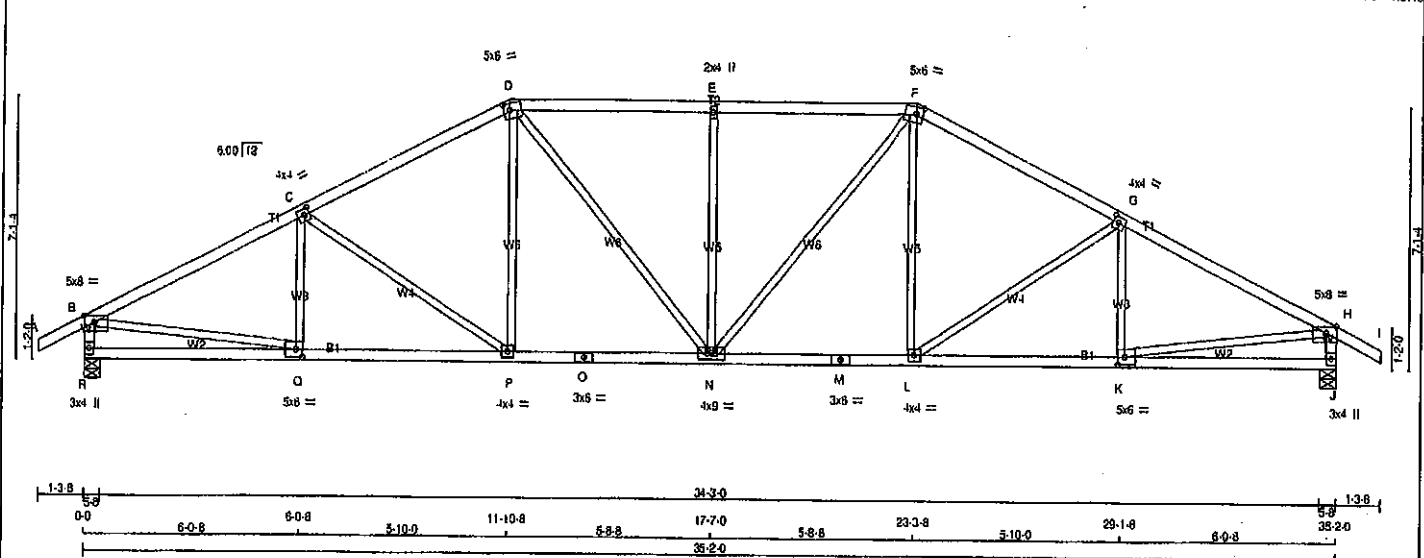

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
E - F	2x4	DRY No.2	SPF
G - I	2x4	DRY No.2	SPF
J - B	2x4	DRY No.2	SPF
K - H	2x4	DRY No.2	SPF
L - O	2x4	DRY No.2	SPF
M - M	2x4	DRY No.2	SPF
N - J	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2
 EXCEPT

DRY: SEASONED LUMBER.

PLATES (feet/inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	3.50
C	TMVW-i	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	6.0	2.25	2.00
E	TMVW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	6.0	2.25	2.00
G	TMVW-i	MT20	4.0	4.0	2.00	1.75
H	TMVW-p	MT20	5.0	8.0	Edge	3.50
J	BMV1-p	MT20	3.0	4.0		
K	BMVW-i	MT20	5.0	6.0	2.50	2.25
L	BMVW-i	MT20	4.0	4.0		
M	BS-i	MT20	3.0	6.0		
N	BMVW-w	MT20	4.0	9.0		
O	BS-i	MT20	3.0	6.0		
P	BMVW-i	MT20	4.0	4.0		
Q	BMVW-i	MT20	5.0	6.0	2.50	2.25
R	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORIZ	UPLIFT
R	2063	0	0	5-8
J	2063	0	0	5-8

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED SNOW LIVE PERM. LIVE WIND DEAD SOIL
R	1457 989 0 0 0 0 488 0 0 0
J	1457 989 0 0 0 0 488 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
 ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD	LC1 MAX	MEMB.	FORCE	MAX
	(LBS)	(PLF)	CSI (LC1)		(LBS)	CSI (LC1)
FR-TO		FROM TO	LENGTH	FR-TO		
A-B	0 28	-91.8 -91.8 0.12 (1)	10.00	Q-C	-255 12	0.07 (1)
B-C	-2889 0	-91.8 -91.8 0.58 (1)	3.58	C-P	-435 0	0.42 (1)
C-D	-2539 0	-91.8 -91.8 0.52 (1)	3.83	P-D	0 350	0.08 (1)
D-E	-2559 0	-91.8 -91.8 0.48 (1)	3.85	O-N	0 -482	0.11 (1)
E-F	-2559 0	-91.8 -91.8 0.48 (1)	3.85	N-E	-641 0	0.58 (1)
F-G	-2539 0	-91.8 -91.8 0.52 (1)	3.83	N-F	0 -482	0.11 (1)
G-H	-2889 0	-91.8 -91.8 0.58 (1)	3.58	L-F	0 350	0.08 (1)
H-I	0 28	-91.8 -91.8 0.12 (1)	10.00	L-G	-435 0	0.42 (1)
R-B	-2014 0	0.0 0.0 0.20 (1)	5.95	K-G	-265 12	0.07 (1)
J-H	-2014 0	0.0 0.0 0.20 (1)	5.95	B-Q	0 2635	0.59 (1)
				K-H	0 2635	0.59 (1)
R-Q	0 0	-18.5 -18.5 0.15 (4)	10.00			
Q-P	0 2809	-18.5 -18.5 0.49 (1)	10.00			
P-O	0 2249	-18.5 -18.5 0.43 (1)	10.00			
O-N	0 2349	-18.5 -18.5 0.43 (1)	10.00			
N-M	0 2249	-18.5 -18.5 0.43 (1)	10.00			
M-L	0 2249	-18.5 -18.5 0.43 (1)	10.00			
L-K	0 2609	-18.5 -18.5 0.49 (1)	10.00			
K-J	0 0	-18.5 -18.5 0.15 (4)	10.00			

TOTAL WEIGHT = 2 X 145 = 289 lb

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 OL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 080-09, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
 CALCULATED VERT. DEFL. (LL) = L/999 (0.15")
 ALLOWABLE DEFL. (TL) = L/360 (1.17")
 CALCULATED VERT. DEFL. (TL) = L/999 (0.28")

CSI: TC=0.58/1.00 (G-H:1), BC=0.49/1.00 (K-L:1), WB=0.59/1.00 (H-K:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1887 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.89 (Q) (INPUT = 0.80)
 JSI METAL= 0.69 (M) (INPUT = 1.00)

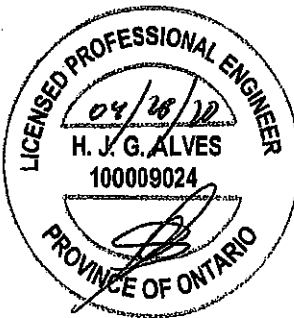

Structural component only
 DWG# T-2007664

JOB NAME: 408224 TRUSS NAME: T44 QUANTITY: 2 PLY: 1 JOB DESC.: GREEN PARK HOMES TRUSS DESC.: Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:20:33 2020 Page 1
 ID: DMCubINVR8Tsf0e31v6l zns11-40dXMzFwOog7vYcZP7xsEE72zACv9c7kJKfxzME79
 Scale = 1:50.0

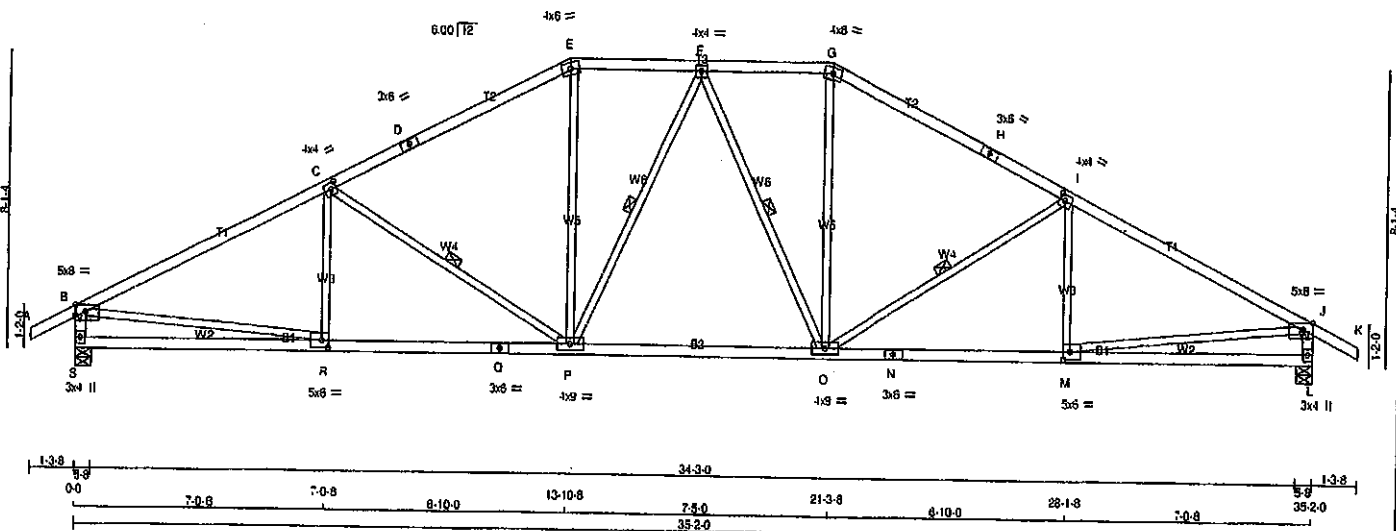

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
E - G	2x4	DRY No.2	SPF
H - K	2x4	DRY No.2	SPF
L - J	2x4	DRY No.2	SPF
M - N	2x4	DRY No.2	SPF
O - P	2x4	DRY No.2	SPF
Q - R	2x4	DRY No.2	SPF
S - T	2x4	DRY No.2	SPF
U - V	2x4	DRY No.2	SPF
W - X	2x4	DRY No.2	SPF
Y - Z	2x4	DRY No.2	SPF
AA - AB	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
8	TMVW-p	MT20	5.0	8.0	Edge	3.50
9	TMVW-t	MT20	4.0	4.0	2.00	1.75
C	TS-t	MT20	3.0	6.0		
D	TS-t	MT20	4.0	6.0		
E	TTW-m	MT20	4.0	4.0		
F	TMVW-t	MT20	4.0	4.0		
G	TTW-m	MT20	4.0	6.0		
H	TS-t	MT20	3.0	6.0		
I	TMVW-t	MT20	4.0	4.0	2.00	1.75
J	TMVW-p	MT20	5.0	8.0	Edge	3.50
L	BMV-t	MT20	3.0	4.0		
M	BMVW-t	MT20	5.0	6.0	2.50	2.25
N	BS-t	MT20	3.0	6.0		
O	BMVW-t	MT20	4.0	9.0		
P	BMVW-t	MT20	4.0	9.0		
Q	BS-t	MT20	3.0	6.0		
R	BMVW-t	MT20	5.0	6.0	2.50	2.25
S	BMV-t	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	IN-SX
S	2063	0	0	2063	0	0	0	5-8	5-8
L	2063	0	0	2063	0	0	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	1457	869	0	0	0	0	488	0
L	1457	969	0	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-P, F-P, F-O, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (LC)	MAX. UNBRACED LENGTH	MEMB.	FORCE (LBS)	MAX (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0 28	-91.8	-91.8	0.12 (1)	10.00	R-C	-182 52 0.06 (1)
B-C	-2908 0	-91.8	-91.8	0.83 (1)	3.25	C-P	-637 0 0.29 (1)
C-D	-2373 0	-91.8	-91.8	0.72 (1)	3.66	P-E	0 674 0.15 (1)
D-E	-2373 0	-91.8	-91.8	0.72 (1)	3.66	F-F	-222 0 0.11 (1)
E-F	-2100 0	-91.8	-91.8	0.19 (1)	4.53	P-O	-222 0 0.11 (1)
F-G	-2100 0	-91.8	-91.8	0.19 (1)	4.53	O-G	0 674 0.15 (1)
G-H	-2373 0	-91.8	-91.8	0.72 (1)	3.66	O-I	-637 0 0.29 (1)
H-I	-2373 0	-91.8	-91.8	0.72 (1)	3.66	M-I	-182 52 0.06 (1)
I-J	-2908 0	-91.8	-91.8	0.83 (1)	3.25	B-R	0 2649 0.80 (1)
J-K	0 28	-91.8	-91.8	0.12 (1)	10.00	M-J	0 2649 0.80 (1)
S-B	-2008 0	0.0	0.0	0.20 (1)	5.96		
L-J	-2008 0	0.0	0.0	0.20 (1)	5.96		
S-R	0 0	-18.5	-18.5	0.20 (4)	10.00		
R-O	0 2630	-18.5	-18.5	0.52 (1)	10.00		
Q-P	0 2630	-18.5	-18.5	0.52 (1)	10.00		
P-O	0 2189	-18.5	-18.5	0.45 (1)	10.00		
O-N	0 2630	-18.5	-18.5	0.52 (1)	10.00		
N-M	0 2630	-18.5	-18.5	0.52 (1)	10.00		
M-L	0 0	-18.5	-18.5	0.20 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.8 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NSCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.30")

CS: TC=0.83/1.00 (K=1), BC=0.52/1.00 (M=0.1), WB=0.60/1.00 (J-M=1), SS=0.28/1.00 (B-C=1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (M) (INPUT = 0.90)
 JSI METAL = 0.79 (Q) (INPUT = 1.00)



Structural component only
 DWG# T-2007665

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T45	2	1	GREEN PARK HOMES	

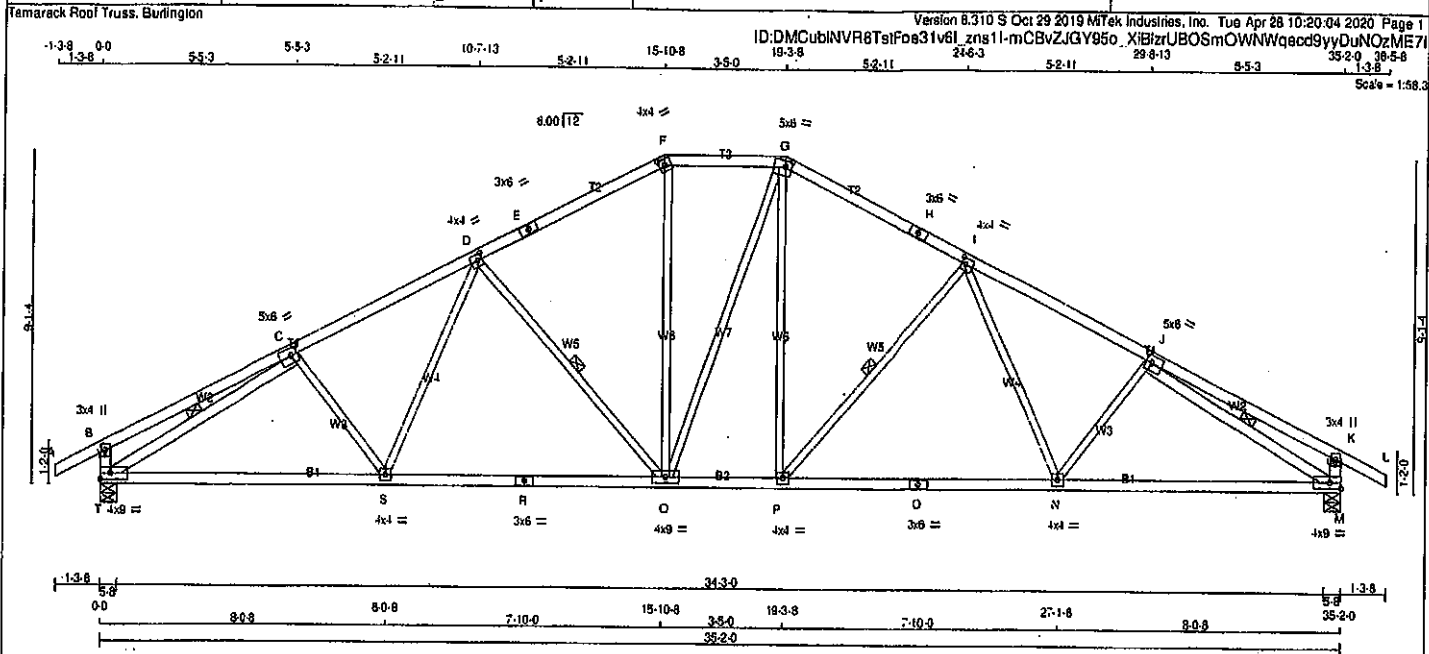

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - E	2x4	DRY	No.2
F - G	2x4	DRY	No.2
H - I	2x4	DRY	No.2
J - K	2x4	DRY	No.2
L - M	2x4	DRY	No.2
N - O	2x4	DRY	No.2
P - Q	2x4	DRY	No.2
R - S	2x4	DRY	No.2
T - U	2x4	DRY	No.2
V - W	2x4	DRY	No.2
X - Y	2x4	DRY	No.2
Z	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
T - C	2x4	DRY	No.2
J - M	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
C	TMVW-i	MT20	5.0	6.0	2.50 2.25
D	TMVW-i	MT20	4.0	4.0	2.00 1.50
E	TS-i	MT20	3.0	6.0	
F	TTW-h	MT20	4.0	4.0	2.00 1.75
G	TTW-m	MT20	5.0	6.0	2.00 2.00
H	TS-i	MT20	3.0	6.0	
I	TMVW-i	MT20	4.0	4.0	2.00 1.50
J	TMVW-i	MT20	5.0	6.0	2.50 2.25
K	TMV+p	MT20	3.0	4.0	
M	BMVW-i	MT20	4.0	9.0	Edge
N, P, S					
N	BMVW-i	MT20	4.0	4.0	
O	BS-i	MT20	3.0	6.0	
Q	BMVW-i	MT20	4.0	9.0	
R	BS-i	MT20	3.0	6.0	
T	BMVW-i	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG	IN-SX
T	2063	0	2063	0	0	5-8	5-8		
M	2063	0	2063	0	0	5-8	5-8		

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
T	1457	989	0	0	0	488	0
M	1457	989	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.88 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF D-Q, I-P, C-T, J-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. UNBRACED LENGTH (FT)
FR-TO				FR-TO			
A-B	0 28	-91.8	-91.8 0.12 (1)	10.00	C-S	-110 37	0.04 (1)
B-C	0 20	-91.8	-91.8 0.32 (1)	10.00	S-D	0 278	0.06 (1)
C-D	-2187 0	-91.8	-91.8 0.40 (1)	3.88	D-Q	-682 0	0.31 (1)
D-E	-2187 0	-91.8	-91.8 0.36 (1)	4.30	Q-F	0 614	0.14 (1)
E-F	-2187 0	-91.8	-91.8 0.36 (1)	4.30	Q-G	0 4	0.00 (1)
F-G	-1925 0	-91.8	-91.8 0.18 (1)	4.71	P-G	0 609	0.14 (1)
G-H	-2165 0	-91.8	-91.8 0.36 (1)	4.30	P-I	-683 0	0.31 (1)
H-I	-2165 0	-91.8	-91.8 0.36 (1)	4.30	I-N	0 279	0.06 (1)
I-J	-2761 0	-91.8	-91.8 0.40 (1)	3.88	N-J	-110 37	0.04 (1)
J-K	0 20	-91.8	-91.8 0.32 (1)	10.00	T-C	-3042 0	0.61 (1)
K-L	0 28	-91.8	-91.8 0.12 (1)	10.00	J-M	-3043 0	0.61 (1)
T-B	-325 0	0.0	0.0 0.03 (1)	7.81			
M-K	-325 0	0.0	0.0 0.03 (1)	7.81			

T-S	0 2537	-18.5	-18.5 0.56 (1)	10.00
S-R	0 2383	-18.5	-18.5 0.63 (1)	10.00
R-Q	0 2383	-18.5	-18.5 0.83 (1)	10.00
Q-P	0 1924	-18.5	-18.5 0.40 (1)	10.00
P-O	0 2382	-18.5	-18.5 0.53 (1)	10.00
O-N	0 2382	-18.5	-18.5 0.53 (1)	10.00
N-M	0 2538	-18.5	-18.5 0.56 (1)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
OL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2016, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.29")

CSK TC=0.40-1.00 (I-J-I), BC=0.56-1.00 (M-N-I), WB=0.61-1.00 (J-M-I), SS=0.20-1.00 (G-I-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.89 (F) (INPUT = 0.90)
JSI METAL = 0.83 (O) (INPUT = 1.00)



Structural component only
DWG# T-2007666

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T47S	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:20:06 2020 Page 1
ID:DMCubiNVR6TstFoe31v6l zns11-bJg_7Hphi2lm0K84GWTtsngADw8c_RQGi_SGzME7d

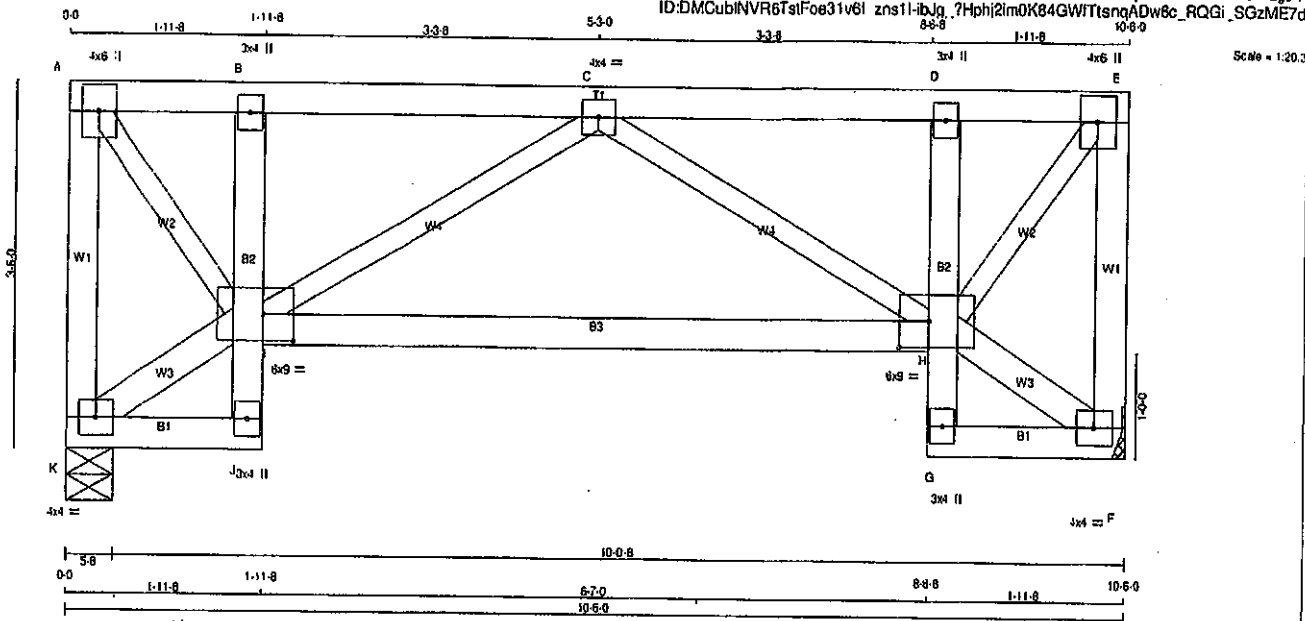

TOTAL WEIGHT = 2 X 51 = 102 lb
(M/R)

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
K - A	2x4	DRY	No.2
A - E	2x4	DRY	No.2
F - E	2x4	DRY	No.2
K - J	2x4	DRY	No.2
J - B	2x4	DRY	No.2
I - H	2x4	DRY	No.2
G - D	2x4	DRY	No.2
G - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
K - I	2x4	DRY	No.2
H - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW+p	MT20	4.0	6.0	
B	TMV+p	MT20	3.0	4.0	
C	TMVW-1	MT20	4.0	4.0	
D	TMV+p	MT20	3.0	4.0	
E	TMVW+p	MT20	4.0	6.0	
F	BMVW-1	MT20	4.0	4.0	
G	BMV+p	MT20	3.0	4.0	
H	BMVW-1	MT20	6.0	9.0	3.00 3.50
I	BMVW-1	MT20	6.0	9.0	3.00 3.50
J	BMV+p	MT20	3.0	4.0	
K	BMVW-1	MT20	4.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING.

BEARINGS

JT	FACTORED		MAXIMUM FACTORED		INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG		
K	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX
K	697	0	697	0	5-8	5-8
F	697	0	697	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS					
K	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
K	504	269 0	0 0	0 0	0 0	235 0	0 0
F	504	269 0	0 0	0 0	0 0	235 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	UNBRAC	MEMB.	MAX. FACTORED	FACTORED	UNBRAC
	FORCE	VERT. LOAD	LENGTH		FORCE	MAX	LENGTH
	(LBS)	(PLF)	CSH (LC)		(LBS)	CSH (LC)	
FR-TO		FROM TO		FR-TO			
K-A	-667 0	0.0 0.0 0.17 (1)	7.81	K-I	-28 0	0.00 (1)	
A-B	-497 0	-114.3 -114.3 0.14 (1)	6.25	A-I	0 783	0.24 (1)	
B-C	-508 0	-114.3 -114.3 0.22 (1)	6.25	H-F	-28 0	0.00 (1)	
C-D	-508 0	-114.3 -114.3 0.22 (1)	6.25	H-E	0 783	0.24 (1)	
D-E	-497 0	-114.3 -114.3 0.14 (1)	6.25	I-C	-384 0	0.15 (1)	
E-F	-667 0	0.0 0.0 0.17 (1)	7.81	C-H	-384 0	0.15 (1)	
K-J	0 25	-18.5 -18.5 0.03 (4)	10.00				
J-I	0 19	0.0 0.0 0.05 (1)	10.00				
I-B	-331 0	0.0 0.0 0.05 (1)	7.81				
I-H	0 832	-18.5 -18.5 0.46 (4)	10.00				
G-H	0 19	0.0 0.0 0.05 (1)	10.00				
H-D	-331 0	0.0 0.0 0.05 (1)	7.81				
G-F	0 25	-18.5 -18.5 0.03 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	15.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	48.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.22/1.00 (B-C:1), BC=0.46/1.00 (H-I:4), WB=0.24/1.00 (E-H:1), SSI=0.22/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.77 (H) (INPUT = 0.90)
JSI METAL = 0.30 (E) (INPUT = 1.00)



Structural component only
DWG# T-2007668

Tamarack Roof Truss, Burlington


Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 26 10:20:27 2020 Page 1

ID:DMCubiNVR6TstFoe31v6l zns1l-Ant2CLIRS0AZOAvKz1u04OyjadNr3HbWsy_rzME7c

1-3-8 1-3-8 0-0 3-0-0 3-0-0 3-7-12 3-9-8 10-8-0

6-7-12 6-8-8 9-12 10-8-0

Scale = 1/16" = 1'-0"

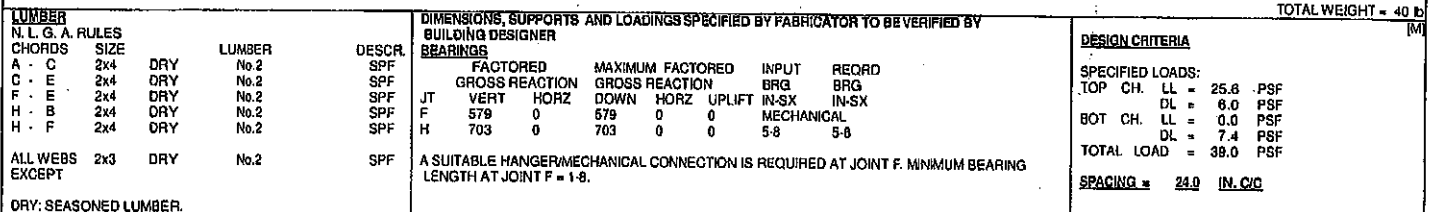

PLATES (table in inches)		W	LEN	Y	X
JT	TYPE	PLATES			
B	TMVW+p	MT20	4.0	4.0	1.50 2.00
C	TTW-m	MT20	4.0	4.0	
D	TMWW-t	MT20	4.0	4.0	
E	TMV+p	MT20	3.0	4.0	
F	BMVW-t	MT20	4.0	4.0	
G	8MWVW-t	MT20	4.0	9.0	
H	8MV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
<u>BEARINGS</u>							
	FACTORED		MAXIMUM FACTORED		INPUT	REQ'D	
	GROSS REACTION		GROSS REACTION		BRG	BRG	
JT	VERT	HORIZ	DOWN	HORIZ	UPLIFT	IN-SX	IN-SX
F	579	0	579	0	0	MECHANICAL	
H	703	0	703	0	0	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS		MAX. MIN. COMPONENT REACTIONS					
JT	1ST LCASE COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	409	269 0	0 0	0 0	0 0	141 0	0 0
H	495	338 0	0 0	0 0	0 0	157 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LOAD LG1 CSI (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)		
FR-TO		FROM TO		LENGTH	FR-TO				
A-B	0 28	-91.8	-91.8 0.12 (1)	10.00	G-C	0 61	0.02 (4)		
B-C	-835 0	-91.8	-91.8 0.15 (1)	6.25	G-D	-61 80	0.02 (4)		
C-D	-569 0	-91.8	-91.8 0.21 (1)	6.25	D-F	-731 0	0.23 (1)		
D-E	0 0	-91.8	-91.8 0.20 (1)	10.00	B-G	0 587	0.13 (1)		
F-E	-135 0	0.0	0.0 0.02 (1)	7.81					
H-B	-699 0	0.0	0.0 0.07 (1)	7.81					
H-G	0 0	-18.5	-18.5 0.21 (4)	10.00					
G-F	0 619	-18.5	-18.5 0.25 (4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 6.0 PSF

BOT CH. LL = 0.0 PSF
DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 5.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBC 2010. NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018 , OBC 2012 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 886-09, CSA 886-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 26.8 P.S.F. SPECIFIED ROOF

ALLOWABLE DEFL.(LL) = 1.360 (0.35")
CALCULATED VERT. DEFL.(LL) = 1.999 (0.01")
ALLOWABLE DEFL.(TL) = 1.360 (0.35")
CALCULATED VERT. DEFL.(TL) = 1.999 (0.01")

CSI: TC=0.21/1.00 (C-D:1) , BC=0.25/1.00 (F-G:4) ,

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS= 1.10
COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES				
PLATE	GRIP (IN)	SHEAR (PSI)	SECTION (PLI)	
	(PSI)	(PLI)	MAX	MIN
MT20	810	254	1507	700
			1007	1500


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL - 5.0 Deg

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.68 (B) INPUT = 0.90]


```
JSI METAL= 0.23 (F) (INPUT = 1.00)
```

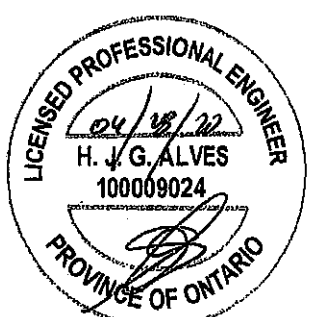

Structural component only
DWG# T-2007669

JOB NAME 408224	TRUSS NAME T49	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:20:08 2020 Page 1
ID:DMCubINVR6TslFoe31v8l_zns1f-ezRQPhJ3DKIQ0JUWCqZ72ix3M_zlaUMktaB5W9zME7b

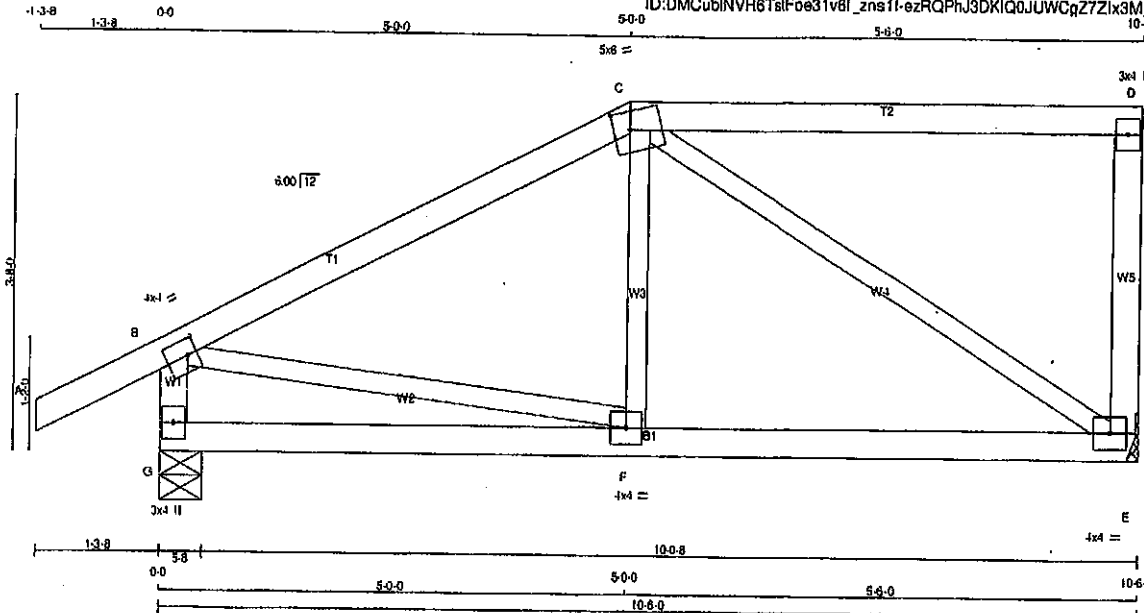

Scale = 1:22.0

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
E - D	2x4	DRY	No.2
G - B	2x4	DRY	No.2
G - E	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (tables in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-1	MT20	4.0	4.0	2.00 1.25
C	TTWW-m	MT20	5.0	6.0	2.25 2.00
D	TMV+p	MT20	3.0	4.0	
E	BMVW-1	MT20	4.0	4.0	
F	BMVW-1	MT20	4.0	4.0	
G	BMV-1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG					
	VERT	HORIZ	DOWN	HORIZ	UPLIFT	IN-SX	IN-SX		
E	579	0	579	0	0	MECHANICAL			
G	703	0	703	0	0	5-8	5-8		

UNFACTORED REACTIONS									
JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS							
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
E	409	289	0	0	0	141	0		
G	495	338	0	0	0	157	0		

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LOAD LC1	MAX. UNBRAC (CS1) (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRAC (CS1) (LC)		
FR-TO					FR-TO				
A-B	0 28	-91.8	-91.8	0.12 (1)	10.00	F-C	0 106	0.04 (4)	
B-C	-523 0	-91.8	-91.8	0.41 (1)	6.25	C-E	-549 0	0.37 (1)	
C-D	0 0	-91.8	-91.8	0.47 (1)	10.00	B-F	0 474	0.11 (1)	
E-D	-252 0	0.0	0.0	0.05 (1)	7.81				
G-B	-687 0	0.0	0.0	0.07 (1)	7.81				
G-F	0 0	-18.5	-18.5	0.14 (4)	10.00				
F-E	0 468	-18.5	-18.5	0.19 (4)	10.00				

TOTAL WEIGHT = 42 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CS1: TC=0.47 (C-D:1), BC=0.19 (E-F:4), WB=0.37 (G-E:1), SG=0.20 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 L8 BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1687 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

**JSI GRIP = 0.85 (B) (INPUT = 0.90)
 JSI METAL = 0.28 (B) (INPUT = 1.00)**

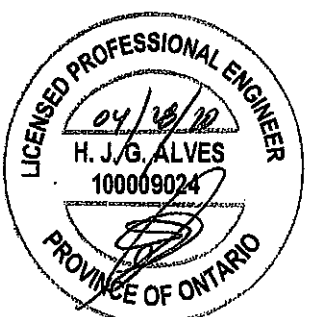

Structural component only
DWG# T-2007670

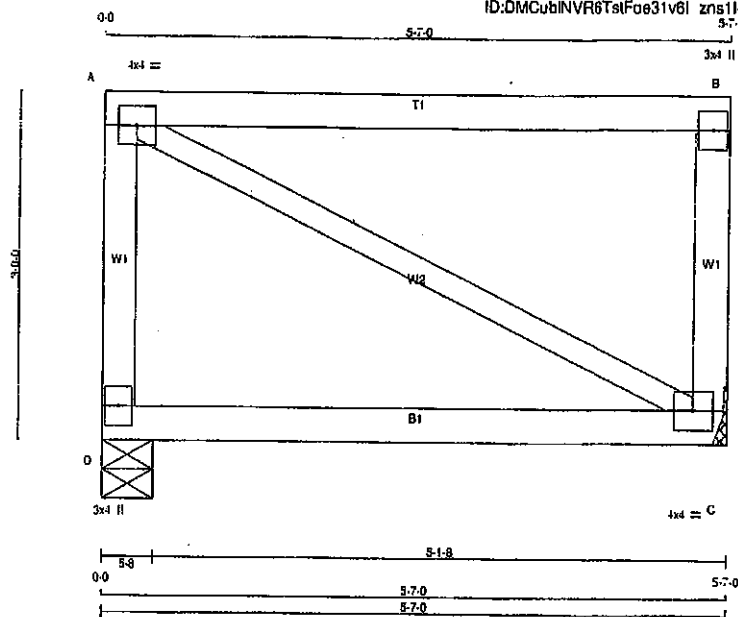

TOTAL WEIGHT = 2 X 23 = 46 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR.
D - A	2x4	DRY	No.2	SPF
A - B	2x4	DRY	No.2	SPF
C - B	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER				

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y
A	TMVW-t	MT20	4.0	4.0	
B	TMV+p	MT20	3.0	4.0	
C	BMVW1-t	MT20	4.0	4.0	
D	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
D	371	0	371	0	0	5-8	5-8
C	371	0	371	0	0	MECHANICAL	

A SUITABLE HANGER MECHANICAL CONNECTION IS REQUIRED AT JOINT C. MINIMUM BEARING LENGTH AT JOINT C = 1-8.

UNFACTORED REACTIONS

1ST LCASE MAX, MIN, COMPONENT REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
D	268	143 '0	0 '0	0 '0	0 '0	125 '0	0 '0
C	268	143 '0	0 '0	0 '0	0 '0	125 '0	0 '0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) OF

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: {4}

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	LC1 MAX CSI (L/C)	MAX. UNBRAC LENGTH	MEMB. FR-TO A-C	MAX. FACTORED FORCE (LBS)	MAX CSI (L/C)
FR-TO		FROM	TO				
D-A	-319 0	0.0	0.0	0.06 (1)	7.81		
A-B	0 0	-114.3	-114.3	0.81 (1)	10.00	0 0	0.00 (1)
C-B	-319 0	0.0	0.0	0.06 (1)	7.81		
D-C	0 0	-18.5	-18.5	0.23 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	15.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	48.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF 8CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)

- PART 9 OF OBC 2012 (2012)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

165 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF
LIVE LOAD

ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.81/1.00 (A-B:1), BC=0.23/1.00 (C-D:4),
WB=0.00/1.00 (A-C:1), SSI=0.33/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)	(PLI)	(PLI)	(PLI)	(PLI)	(PLI)
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1687	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.25 (A) (INPUT = 0.90)
JSI METAL= 0.07 (A) (INPUT = 1.00)




Structural component only
DWG# T-2007671

JOB NAME 408224	TRUSS NAME G50	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:19:51 2020 Page 1
ID:DMCubINVR8TstFoe31v6I zns1f-civ7r16OD69qTthFic7MikFo7CC5i2EzRaiQozME7s

Scale = 1:16.1

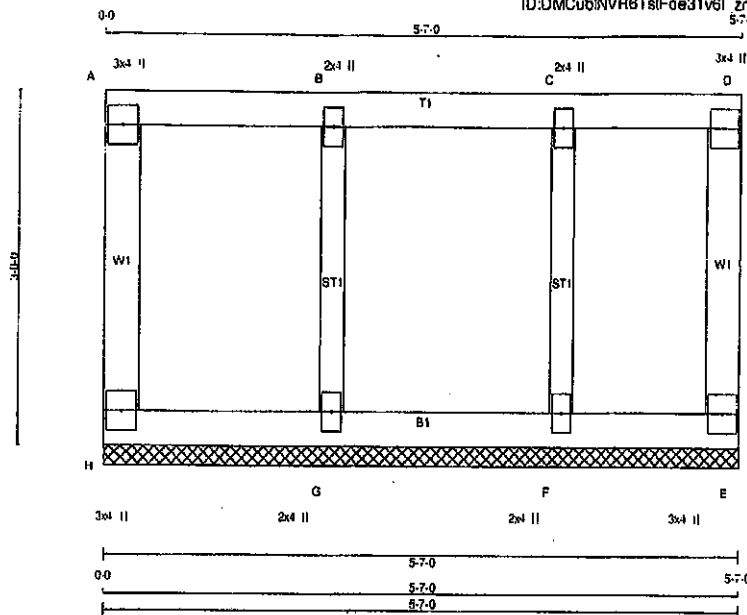

TOTAL WEIGHT = 22 lb (M/R)

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
H - A	2x4	DRY	No.2
A - D	2x4	DRY	No.2
E - D	2x4	DRY	No.2
H - E	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
ALL GABLE WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B	TMW+w	MT20	2.0	4.0		
C	TMW+w	MT20	2.0	4.0		
D	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		
F	BMW1+w	MT20	2.0	4.0		
G	BMW1+w	MT20	2.0	4.0		
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING.

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. GSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. GSI (LC)	UNBRACED LENGTH (FT)
FR-TO		FROM	TO	FR-TO			
H-A	-101 0	0.0	0.0 0.03 (1)	G-B	-248 0	0.08 (1)	7.81
A-B	-8 0	-114.3	-114.3 0.08 (1)	F-C	-209 0	0.05 (1)	10.00
B-C	-8 0	-114.3	-114.3 0.08 (1)				
C-D	-8 0	-114.3	-114.3 0.08 (1)				
E-D	-80 0	0.0	0.0 0.03 (1)				
H-G	0 8	-18.5	-18.5 0.02 (4)				
G-F	0 8	-18.5	-18.5 0.02 (4)				
F-E	0 8	-18.5	-18.5 0.02 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.8 PSF
	DL	= 15.0 PSF
BOT CH.	LL	= 0.0 PSF
	DL	= 7.4 PSF
TOTAL LOAD	=	48.0 PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

GSI: TC=0.08/1.00 (A-B:1), BC=0.02/1.00 (G-H:1), WB=0.08/1.00 (B-G:1), SE=0.13/1.00 (A-B:1)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.17 (G) INPUT = 0.90
JSI METAL = 0.07 (G) INPUT = 1.00



Structural component only
DWG# T-2007656


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	T51	1	1	TRUSS DESC.		

Tambrack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:20:11 2020 Page 1

ID:DMCubINVR6TstFoe31v6l_zns11-3Y6Z1ILxWFG?tnD5lp8qAwZamBzqnsmAzyQI7UzME7Y

Scale = 1:20.5

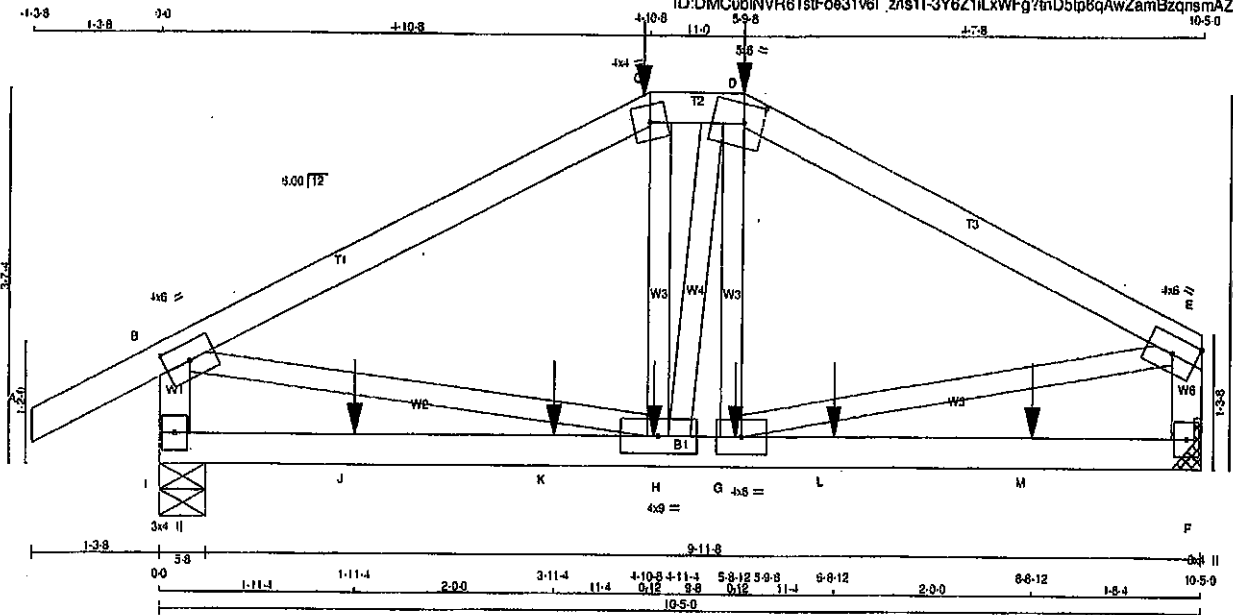

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
E - F	2x4	DRY	No.2	SPF	
F - G	2x4	DRY	No.2	SPF	
G - H	2x4	DRY	No.2	SPF	
H - I	2x4	DRY	No.2	SPF	
I - J	2x4	DRY	No.2	SPF	
J - K	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	6.0	2.00	3.00
C	TTW-m	MT20	4.0	4.0		
D	TTW-m	MT20	5.0	6.0	2.25	2.25
E	TMVW-1	MT20	4.0	6.0		Edge
F	BMV1+p	MT20	3.0	4.0		
G	BMVW-1	MT20	4.0	6.0		
H	BMVW-1	MT20	4.0	6.0		
I	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UPLIFT
I	1104	0	1104	0
F	1000	0	1000	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3'-8".

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	DEAD	SOIL
I	778	525 0	0 0	253 0
F	707	465 0	0 0	242 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.22 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: 14)

CHORDS	MEMB.	MAX. FACTORED	FACTORED	MAX.	MEMB.	MAX. FACTORED	FACTORED	MAX.
		FORCE	VERT. LOAD	LC1 MAX		FORCE	VERT. LOAD	LC1 MAX
		(LBS)	(PLF)	CSI (LC)		(LBS)	(PLF)	CSI (LC)
FR-TO					FR-TO			
A-B	0 28	-91.8	-91.8	0.13 (1)	H-C	-99 54	0.02 (1)	
B-C	-1177 0	-91.8	-91.8	0.46 (1)	H-D	0 30	0.01 (4)	
C-D	-1045 0	-91.8	-91.8	0.03 (1)	G-D	-120 24	0.03 (1)	
D-E	-1187 0	-91.8	-91.8	0.41 (1)	B-H	0 1067	0.28 (1)	
E-F	-1053 0	0.0	0.0	0.12 (1)	G-E	0 1066	0.28 (1)	
F-G	-953 0	0.0	0.0	0.11 (1)				
I-J	0 0	-18.5	-18.5	0.19 (4)				
J-K	0 0	-18.5	-18.5	0.19 (4)				
K-H	0 0	-18.5	-18.5	0.19 (4)				
H-G	0 1039	-18.5	-18.5	0.28 (4)				
G-L	0 0	-18.5	-18.5	0.16 (4)				
L-M	0 0	-18.5	-18.5	0.16 (4)				
M-F	0 0	-18.5	-18.5	0.16 (4)				

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-10-8	-381	-381	---	---	FRONT	VERT	TOTAL	---	C1
D	5-8-8	-381	-381	---	---	FRONT	VERT	TOTAL	---	C1
G	5-8-12	-19	-19	---	---	FRONT	VERT	TOTAL	---	C1
H	4-11-4	-19	-19	---	---	FRONT	VERT	TOTAL	---	C1
J	1-11-4	-17	-17	---	---	FRONT	VERT	TOTAL	---	C1
K	3-11-4	-19	-19	---	---	FRONT	VERT	TOTAL	---	C1
L	6-8-12	-19	-19	---	---	FRONT	VERT	TOTAL	---	C1
M	8-8-12	-17	-17	---	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
DL	=	6.0	PSF	
BOT CH.	LL	=	0.0	PSF
DL	=	7.4	PSF	
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

15% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.48/1.00 (B-C:1), BC=0.28/1.00 (G-H:1), WB=0.26/1.00 (B-H:1), SS=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.71 (G) (INPUT = 0.90)
JSI METAL=0.33 (G) (INPUT = 1.00)




Structural component only
DWG# T-2007672

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T52	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:20:12 2020 Page 1
ID:DMCubINVR6TsF0e31v6l_zns11-Xlqx2MaHZpsUx0IRWd3j86qEbM8WMgKoC9JlWzME7X

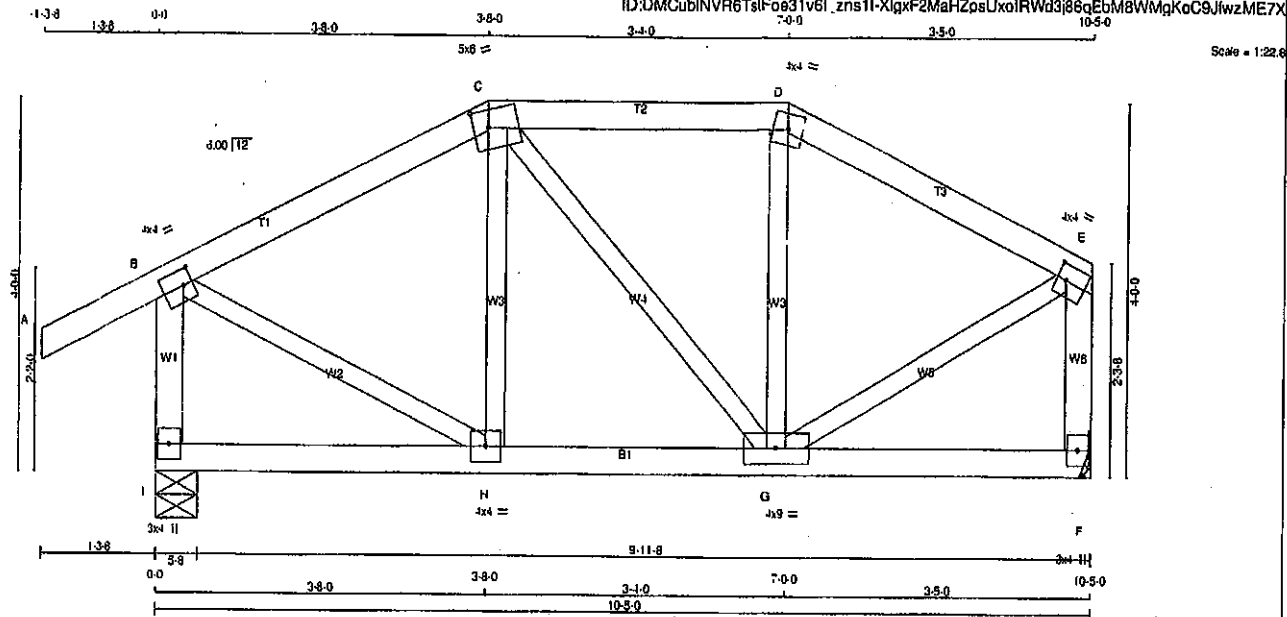

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2

ALL WEBS EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMW-1	MT20	4.0	4.0	2.00	1.25
C	TTW-m	MT20	5.0	6.0	2.25	2.00
D	TTW-m	MT20	4.0	4.0		
E	TMW-1	MT20	4.0	4.0	2.00	1.25
F	BMV1+p	MT20	3.0	4.0		
G	BMWW-1	MT20	4.0	9.0		
H	BMWW-1	MT20	4.0	4.0		
I	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT RECD
	VERT	DOWN	BRG
I	699	0	5-8
F	574	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	492	338	0	0	0	0	156	0
F	408	267	0	0	0	0	140	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)
A-B	0 28	-91.8	10.00
B-C	-423 0	-91.8	8.25
C-D	-382 0	-91.8	8.25
D-E	-409 0	-91.8	8.25
E-F	-669 0	0.0	7.81
F-G	-548 0	0.0	7.81
G-H	0 0	-18.5	10.00
H-I	0 375	-18.5	10.00
I-F	0 0	-18.5	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.16/1.00 (B-C:1), BC=0.09/1.00 (G-H:1), WB=0.09/1.00 (B-H:1), SSI=0.12/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
MT20	618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (B) INPUT = 0.90
JSI METAL = 0.21 (B) INPUT = 1.00

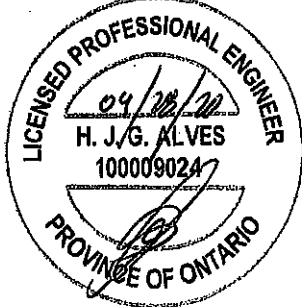


Structural component only
DWG# T-2007673

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T54S	1	2	GREEN PARK HOMES	
TAMARACK ROOF TRUSS, BURLINGTON					

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:20:14 2020 Page 1
ID:DMCubINVR6TstFoe31v6I zns1I-T7ohgkOapA3ZkEygYxqXoZB2uPsf_43dGWecKpzME7V

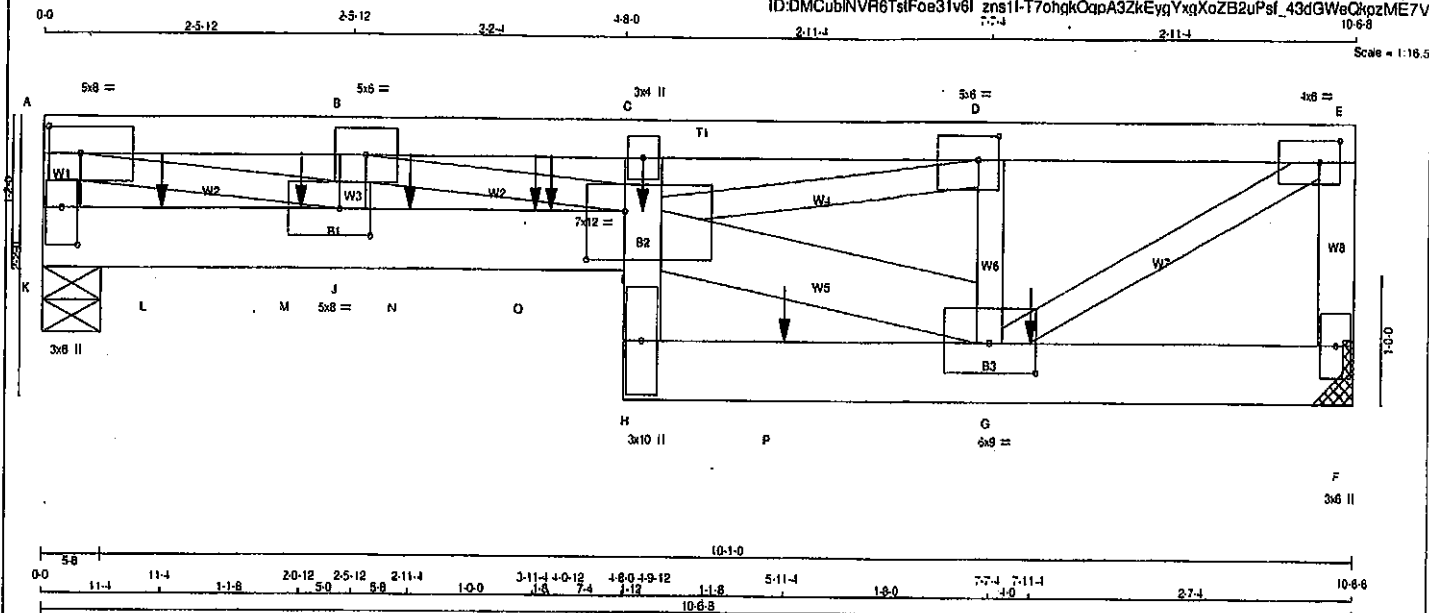


LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
K - A	2x4	DRY	No.2	SPF	
A - E	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
K - I	2x6	DRY	No.2	SPF	
H - C	2x4	DRY	No.2	SPF	
H - F	2x6	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
I - G	2x6	DRY	No.2	SPF	

DRY: SEASONED LUMBER.
DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122'X3") SPIRAL NAILS		
K-A	12	TOP
A-E	12	TOP
E-F	12	TOP
BOTTOM CHORDS : (0.122'X3") SPIRAL NAILS		
K-I	12	SIDE (81.0)
H-F	12	SIDE (183.1)
C-H	5	SIDE (89.8)
WEBS : (0.122'X3") SPIRAL NAILS		
2x3	6	
2x6	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.
GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.
TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY
SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

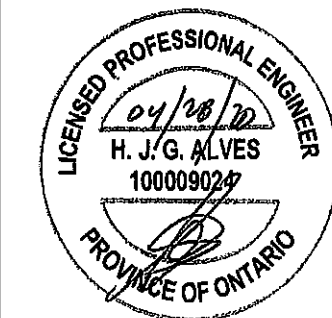

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG	
JT VERT	1841	0	2804	0
K F	1892	0	2255	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F MINIMUM BEARING LENGTH AT JOINT F = 4'-0"

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	1841
K VERT	1892
F	1892

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.36 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MEMB.	FORCE (LBS)
FR-TO			FR-TO	
K-A	-2274	0.0	I-G	0 2886
A-B	-6894	-91.8	I-D	0 5928
B-C	-10298	-91.8	G-D	-2146 0
C-D	-9247	-91.8	G-E	0 4043
D-E	-3416	-91.8	J-B	-1577 0
F-E	-2242	0.0	A-J	0 7027
			B-I	0 3806
K-L	0 0	-18.5		
L-M	0 0	-18.5		
M-J	0 0	-18.5		
J-N	0 6894	-18.5		
N-O	0 6894	-18.5		
O-I	0 6894	-18.5		
H-I	0 354	0.0		
I-C	0 128	0.0		
H-P	0 832	-18.5		
P-G	0 832	-18.5		
G-F	0 0	-18.5		

FACTORED CONCENTRATED LOADS (LBS)	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
JT	7-11-4	-881	-881	---	BACK	VERT	TOTAL	C1
G	4-9-12	-577	-577	---	FRONT	VERT	TOTAL	C1
L	11-4	-72	-72	---	BACK	VERT	TOTAL	C1
M	2-0-12	-352	-352	---	FRONT	VERT	TOTAL	C1
N	2-11-4	-142	-142	---	BACK	VERT	TOTAL	C1
O	3-11-4	-883	-883	---	BACK	VERT	TOTAL	C1
P	4-0-12	-354	-354	---	FRONT	VERT	TOTAL	C1
	5-11-4	-556	-556	---	BACK	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35')
CALCULATED VERT. DEFL.(LL) = L/862 (0.15')
ALLOWABLE DEFL.(TL) = L/360 (0.35')
CALCULATED VERT. DEFL.(TL) = L/469 (0.27')

CS: TC=0.66(1.0)(B-C:1), BC=0.79(1.0)(H-J:1), WB=0.87(1.0)(A-J:1), SS=0.45(1.0)(C-I:1)

0.0 LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (E) INPUT = 0.90
JSI METAL= 0.73 (D) INPUT = 1.00


JOB NAME 408224	TRUSS NAME T54S	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:20:14 2020 Page 2 ID:DMCubINVR6TstFoe31v6l zns11-T7ohqkQqpA3ZkEvgYxpXoZB2uPsf 43dGWaQkpozME7V	

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWW-I	MT20	5.0	8.0	2.50	3.00
B	TMWW-I	MT20	5.0	8.0		
C	TMV+p	MT20	3.0	4.0		
D	TMWW-I	MT20	5.0	6.0	2.25	2.00
E	TMWW-I	MT20	4.0	6.0	2.00	2.00
F	BMV+p	MT20	3.0	8.0		
G	BMWWW-I	MT20	6.0	9.0	2.75	4.50
H	BMV+p	MT20	3.0	10.0		
I	BVMWWW-I	MT20	7.0	12.0	4.50	3.75
J	BMWW-I	MT20	5.0	8.0	2.50	3.00
K	BMV+p	MT20	3.0	6.0	3.50	1.50



Structural component only
DWG# T-2007675 *HL*

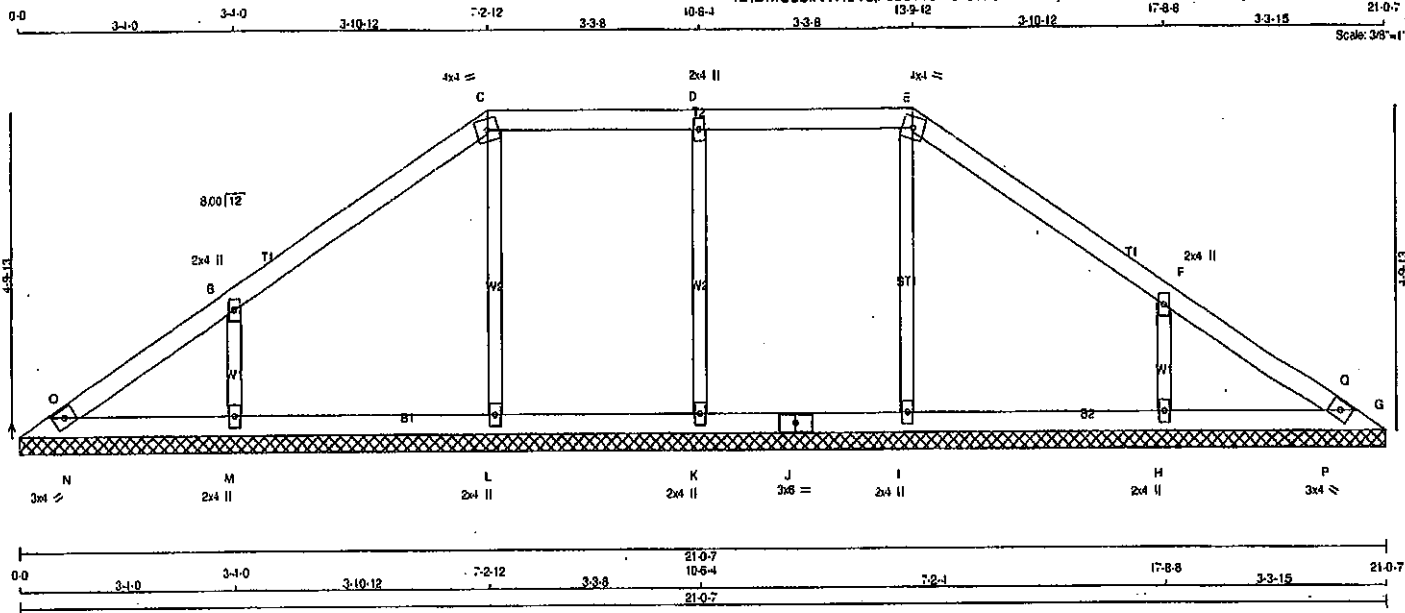

TOTAL WEIGHT = 83 lb (M)

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	No.2
A - O	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
A - J	2x4	DRY	No.2
J - G	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
 DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TBM1-h	MT20	3.0	4.0		
B, D, F						
B	TMW+w	MT20	2.0	4.0		
C	TTW-m	MT20	4.0	4.0		
E	TTW-m	MT20	4.0	4.0		
G	TBM1-h	MT20	3.0	4.0		
H, I, K, L, M						
H	BMW1+w	MT20	2.0	4.0		
J	BS-1	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	RECORD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
A	128	0	128	0	21-0-7 (11-11)200-7	
G	128	0	128	0	21-0-7 (11-11)200-7	
I	330	0	330	0	21-0-7 (11-11)200-7	
L	330	0	330	0	21-0-7 (11-11)200-7	
K	485	0	485	0	21-0-7 (11-11)200-7	
H	485	0	485	0	21-0-7 (11-11)200-7	
M	485	0	485	0	21-0-7 (11-11)200-7	

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX. MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	90	61	0	0	0	29	0
G	90	61	0	0	0	29	0
I	235	143	0	0	0	93	0
L	235	143	0	0	0	93	0
K	342	212	0	0	0	92	0
H	342	228	0	0	0	114	0
M	342	228	0	0	0	114	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, G, I, L, K, H, M

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: 14)

CHORDS						WEBS					
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)			
FR-TO		FROM	TO			FR-TO					
A-O	-23 2	-91.8	-91.8	0.04 (1)	6.25	I-E	-266 0	0.09 (1)			
O-B	0 33	-91.8	-91.8	0.21 (1)	10.00	L-C	-268 0	0.09 (1)			
B-C	-8 8	-91.8	-91.8	0.20 (1)	10.00	K-D	-377 0	0.13 (1)			
C-D	0 17	-91.8	-91.8	0.17 (1)	10.00	H-F	-393 0	0.06 (1)			
D-E	0 17	-91.8	-91.8	0.17 (1)	10.00	M-B	-393 0	0.06 (1)			
E-F	-8 8	-91.8	-91.8	0.20 (1)	10.00	N-O	-39 5	0.00 (1)			
F-G	0 33	-91.8	-91.8	0.21 (1)	10.00	P-Q	-39 5	0.00 (1)			
O-G	-23 2	-91.8	-91.8	0.04 (1)	6.25						
A-N	-8 0	-18.5	-18.5	0.05 (1)	10.00						
N-M	-7 7	-18.5	-18.5	0.06 (4)	10.00						
M-L	-11 0	-18.5	-18.5	0.06 (4)	6.25						
L-K	-17 0	-18.5	-18.5	0.05 (4)	6.25						
K-J	-17 0	-18.5	-18.5	0.05 (4)	6.25						
J-I	-17 0	-18.5	-18.5	0.05 (4)	6.25						
I-H	-11 0	-18.5	-18.5	0.06 (4)	6.25						
H-P	-7 7	-18.5	-18.5	0.06 (4)	10.00						
P-G	-8 0	-18.5	-18.5	0.05 (1)	10.00						

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.21 (B-O:1), BC=0.06 (L-M:4), WB=0.13 (D-K:1), SSI=0.15 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.61 (C) INPUT = 0.90
 JSI METAL = 0.20 (F) INPUT = 1.00




Structural component only
 DWG# T-2007616

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	V2	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:00:15 2020 Page 1

ID:DMCubINVR6TstFoe31v6f zns1i-UKTTnJa hPUUkaLwZ38oYw1qu824qFkOezotZMFIU

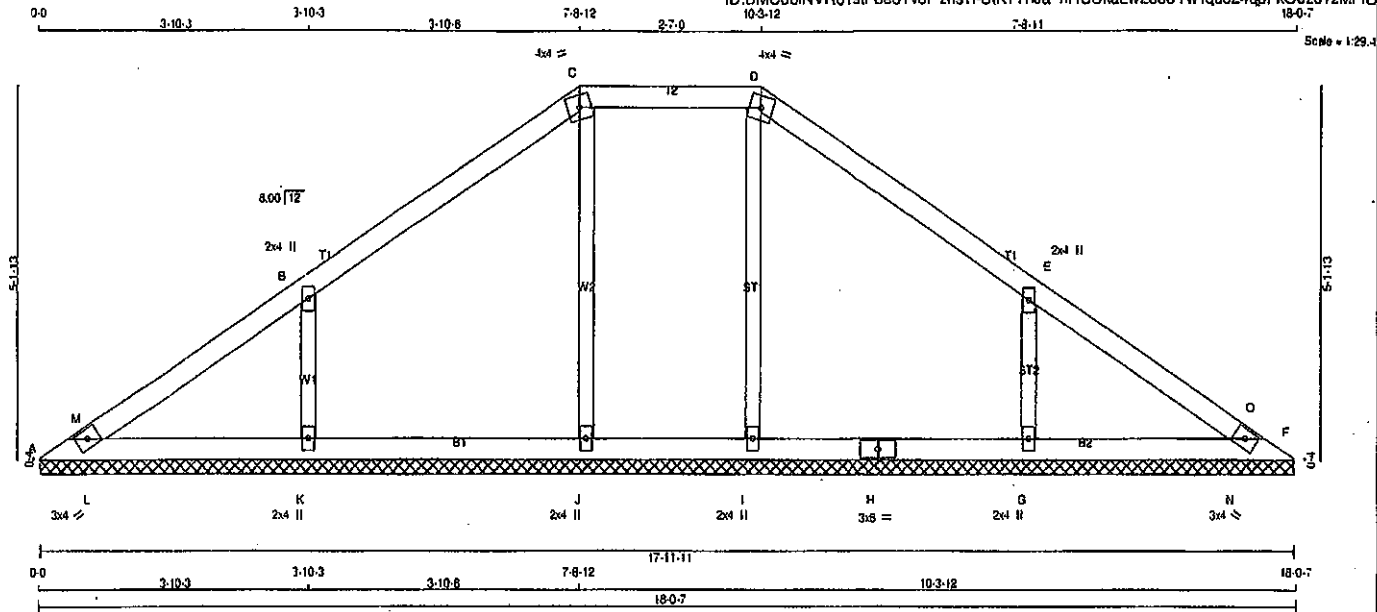

TOTAL WEIGHT = 54 lb

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	SPF	
A - C	2x4	DRY	No.2	SPF	
C - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
A - H	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	X
A	TBM1-h	MT20	3.0	4.0	
B	TMW-w	MT20	2.0	4.0	
C	TTW-m	MT20	4.0	4.0	
D	TTW-m	MT20	4.0	4.0	
E	TMW-w	MT20	2.0	4.0	
F	TBM1-h	MT20	3.0	4.0	
G, I, J, K					
G	BMW1-w	MT20	2.0	4.0	
H	BS4	MT20	3.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
A	138	0	136	0	17-11-11	11-17-12-11
F	135	0	135	0	17-11-11	11-17-12-11
I	344	0	344	0	17-11-11	11-17-12-11
G	513	0	513	0	17-11-11	11-17-12-11
J	342	0	342	0	17-11-11	11-17-12-11
K	513	0	513	0	17-11-11	11-17-12-11

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST LOASE	MAX. MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	95	65	0	0	0	30	0
F	95	65	0	0	0	30	0
I	244	155	0	0	0	89	0
G	362	240	0	0	0	122	0
J	242	154	0	0	0	88	0
K	362	240	0	0	0	122	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, F, I, G, J, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO	LENGTH FR-TO	FR-TO			
A-M	0 20	-91.8 -91.8 0.04 (1)	10.00	I-D	-292 0	0.11 (1)	
M-B	0 71	-91.8 -91.8 0.22 (1)	10.00	G-E	-408 0	0.07 (1)	
B-C	0 33	-91.8 -91.8 0.22 (1)	10.00	J-C	-291 0	0.11 (1)	
C-D	0 52	-91.8 -91.8 0.11 (1)	10.00	K-B	-408 0	0.07 (1)	
D-E	0 33	-91.8 -91.8 0.22 (1)	10.00	L-M	-71 4	0.00 (1)	
E-O	0 71	-91.8 -91.8 0.22 (1)	10.00	N-O	-89 5	0.00 (1)	
O-F	0 19	-91.8 -91.8 0.04 (1)	10.00				
A-L	-43 0	-18.5 -18.5 0.07 (1)	8.25				
L-K	-30 0	-18.5 -18.5 0.07 (1)	8.25				
K-J	-45 0	-18.5 -18.5 0.07 (4)	8.25				
J-I	-52 0	-18.5 -18.5 0.04 (4)	8.25				
I-H	-45 0	-18.5 -18.5 0.07 (4)	8.25				
H-G	-45 0	-18.5 -18.5 0.07 (4)	8.25				
G-N	-30 0	-18.5 -18.5 0.07 (1)	8.25				
N-F	-43 0	-18.5 -18.5 0.07 (1)	8.25				

DESIGN CRITERIA

DESIGNED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS1: TO=0.22:1.00 (E-O:1), BC=0.07:1.00 (K-L:1), WB=0.11:1.00 (D-I:1), SS=0.14:1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1667 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.61 (C) (INPUT = 0.90)
JSI METAL= 0.21 (E) (INPUT = 1.00)

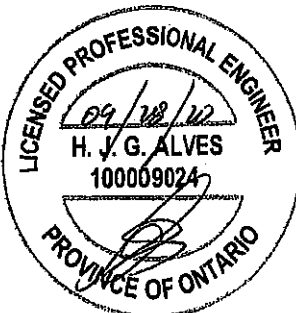


Structural component only
DWG# T-2007617

JOB NAME 408222	TRUSS NAME V3	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:00:16 2020 Page 1

ID:DMCubINVR6TslFoe31v6l_zns1l-y4trq7JCl_ZL6u9XTGaNLmTCHVXpH4Oy2OWKvzMFIT

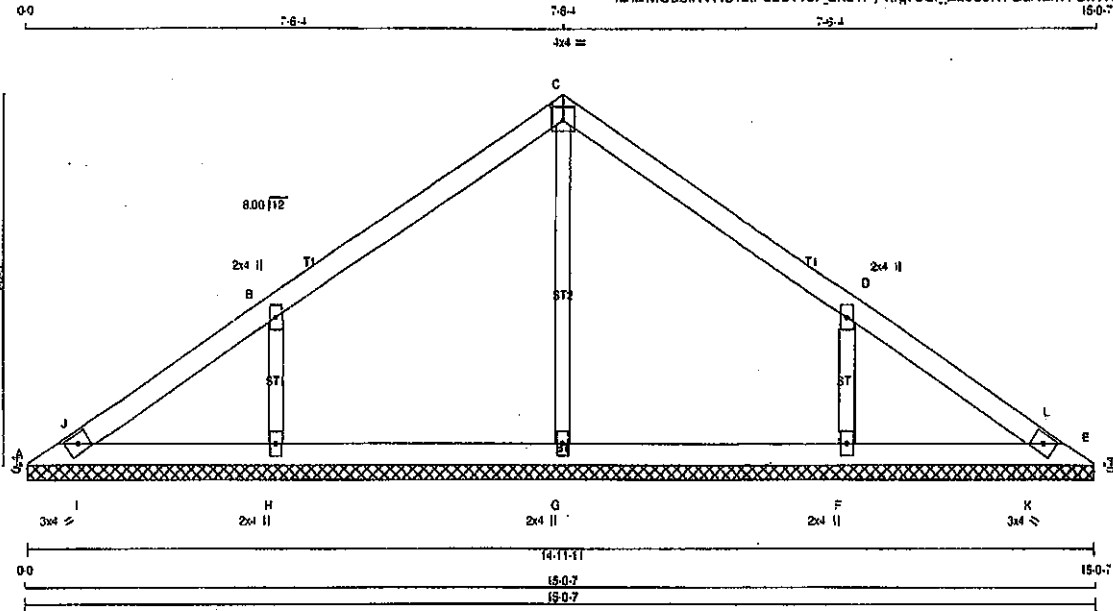

Scale = 1:28.8

TOTAL WEIGHT = 43 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
A - E	2x4	DRY	No.2
A - E	2x4	DRY	No.2
ALL WEBS 2x3 DRY			
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
A		134	0	134	0	0	14-11-11	14-11-11	
E		134	0	134	0	0	14-11-11	14-11-11	
G		381	0	381	0	0	14-11-11	14-11-11	
H		501	0	501	0	0	14-11-11	14-11-11	
F		501	0	501	0	0	14-11-11	14-11-11	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018 - OBC 2012 - ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPC 2011, TPC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TO=0.22(1.00 (B-J:1), BC=0.06(1.00 (G-H:4), WB=0.11(1.00 (C-G:1), SSI=0.15(1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.28 (D) (INPUT = 0.80)
JSI METAL = 0.21 (D) (INPUT = 1.00)

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TBM1-h	MT20	3.0	4.0	
B	TMW+w	MT20	2.0	4.0	
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TMW+w	MT20	2.0	4.0	
E	TBM1-h	MT20	3.0	4.0	
F, G, H	BMW1+w	MT20	2.0	4.0	

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	SNOW	LIVE	PERM. LIVE	WIND
A	95	85	0	0	0	0	0	30	0	0	0
E	95	85	0	0	0	0	0	30	0	0	0
G	272	182	0	0	0	0	0	110	0	0	0
H	353	237	0	0	0	0	0	116	0	0	0
F	353	237	0	0	0	0	0	116	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, G, H, F

BRACING


TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. LC1	MEMB.	FORCE (LBS)	MAX. LC1	MAX. UNBRAC
FR-TO		FROM TO	LENGTH	FR-TO		FROM TO	LENGTH
A-J	-20 4	-91.8 -91.8	0.04 (1)	G-C	-316 0	0.11 (1)	6.25
J-B	0 38	-91.8 -91.8	0.22 (1)	H-B	-406 0	0.08 (1)	10.00
B-C	-5 12	-91.8 -91.8	0.21 (1)	F-D	-406 0	0.08 (1)	10.00
C-D	-5 12	-91.8 -91.8	0.21 (1)	I-J	-46 6	0.00 (1)	10.00
D-L	0 38	-91.8 -91.8	0.22 (1)	K-L	-46 6	0.00 (1)	10.00
L-E	-20 4	-91.8 -91.8	0.04 (1)				6.25
A-I	-13 0	-18.5 -18.5	0.08 (1)				6.25
I-H	-10 3	-18.5 -18.5	0.08 (4)				6.25
H-G	-13 0	-18.5 -18.5	0.08 (4)				6.25
G-F	-13 0	-18.5 -18.5	0.08 (4)				6.25
F-K	-10 3	-18.5 -18.5	0.08 (4)				6.25
K-E	-13 0	-18.5 -18.5	0.08 (1)				6.25

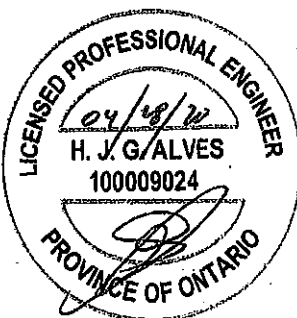


Structural component only
DWG# T-2007618

JOB NAME 408222	TRUSS NAME V4	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 28 2019 Mtek Industries, Inc. Tue Apr 28 11:37:42 2020 Page 1

ID:DMCubINVR6TslFoe31v8l_zns1I-NKegA2eMCG4MYH_q62VAKhU82Pb0QNm3IZNsPzMD_1

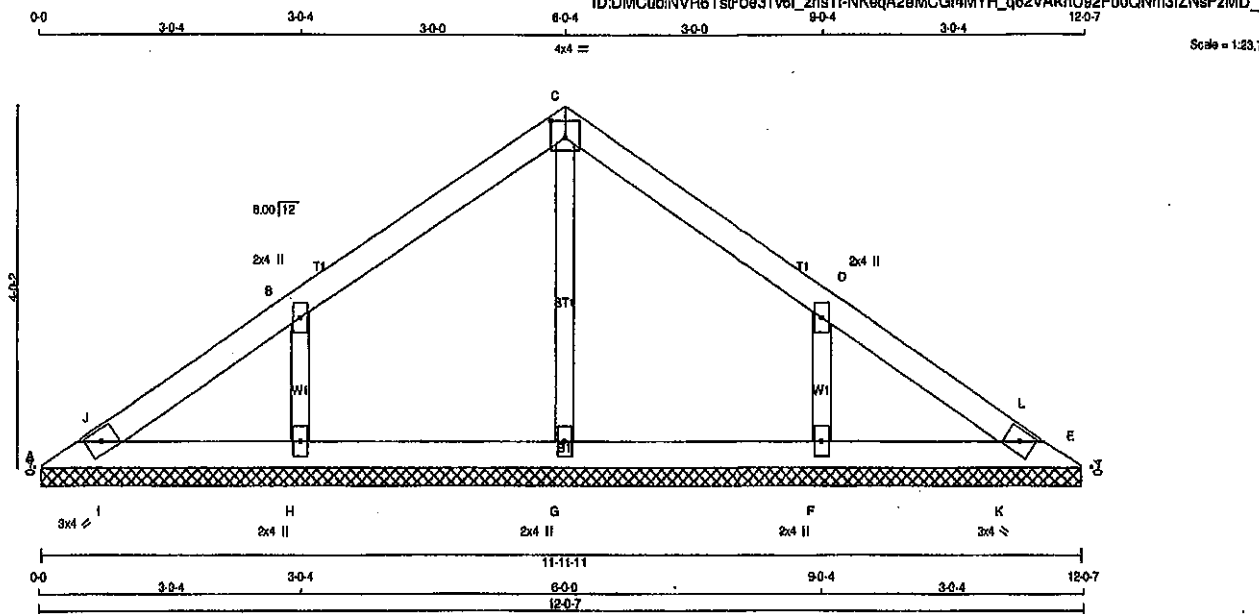

TOTAL WEIGHT = 34 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
A - E	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (tablets in inches)	PLATES	W	LEN	Y	X
A TBM1-h	MT20	3.0	4.0		
B TMW+w	MT20	2.0	4.0		
C TTW-p	MT20	4.0	4.0	2.25	2.00
D TMW+w	MT20	2.0	4.0		
E TBM1-h	MT20	3.0	4.0		
F, G, H					
F BMW1+w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
A	117	0	117	0	0	11-11-11	11-11-11
E	117	0	117	0	0	11-11-11	11-11-11
G	280	0	280	0	0	11-11-11	11-11-11
F	398	0	398	0	0	11-11-11	11-11-11
H	398	0	398	0	0	11-11-11	11-11-11

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	83	58/0	0/0	0/0	0/0	26/0	0/0
E	83	58/0	0/0	0/0	0/0	26/0	0/0
G	207	125/0	0/0	0/0	0/0	82/0	0/0
F	281	188/0	0/0	0/0	0/0	93/0	0/0
H	281	188/0	0/0	0/0	0/0	93/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, G, F, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LGT MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED MAX CSI (LC)		
FR-TO		FROM TO			FR-TO				
A-J	-8/5	-91.8	-91.8	0.03 (1)	10.00	G-C	-248/0 0.08 (1)		
J-B	0/38	-91.8	-91.8	0.13 (1)	10.00	F-D	-314/0 0.05 (1)		
B-C	0/12	-91.8	-91.8	0.13 (1)	10.00	H-B	-314/0 0.05 (1)		
C-D	0/12	-91.8	-91.8	0.13 (1)	10.00	I-J	-47/4 0.00 (1)		
D-L	0/38	-91.8	-91.8	0.13 (1)	10.00	K-L	-47/4 0.00 (1)		
L-E	-8/5	-91.8	-91.8	0.03 (1)	10.00				
A-I	-13/0	-18.5	-18.5	0.05 (1)	6.25				
I-H	-10/0	-18.5	-18.5	0.05 (1)	10.00				
H-G	-20/0	-18.5	-18.5	0.04 (4)	6.25				
G-F	-20/0	-18.5	-18.5	0.04 (4)	6.25				
F-K	-10/0	-18.5	-18.5	0.05 (1)	10.00				
K-E	-13/0	-18.5	-18.5	0.05 (1)	6.25				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8	PSF
	DL = 8.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(85 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.13/1.00 (B-J:1), BC=0.05/1.00 (A-I:1), WB=0.08/1.00 (G-G:1), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PS)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1887 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.22 (D) (INPUT = 0.50)
JSI METAL= 0.16 (B) (INPUT = 1.00)

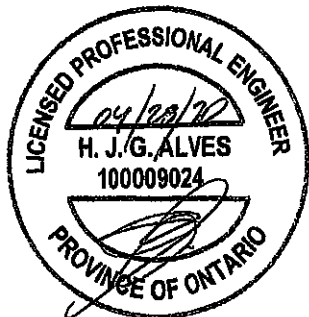

Structural component only
DWG# T-2007619

JOB NAME 408222	TRUSS NAME V5	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 M&T Industries, Inc. Tue Apr 28 09:00:17 2020 Page 1
ID:DMCubINVR6TslFoe31v6L_zns11-QGREITKqWlnCk2kk1_6olz?N9lp5YjBY6i74LzMFIS

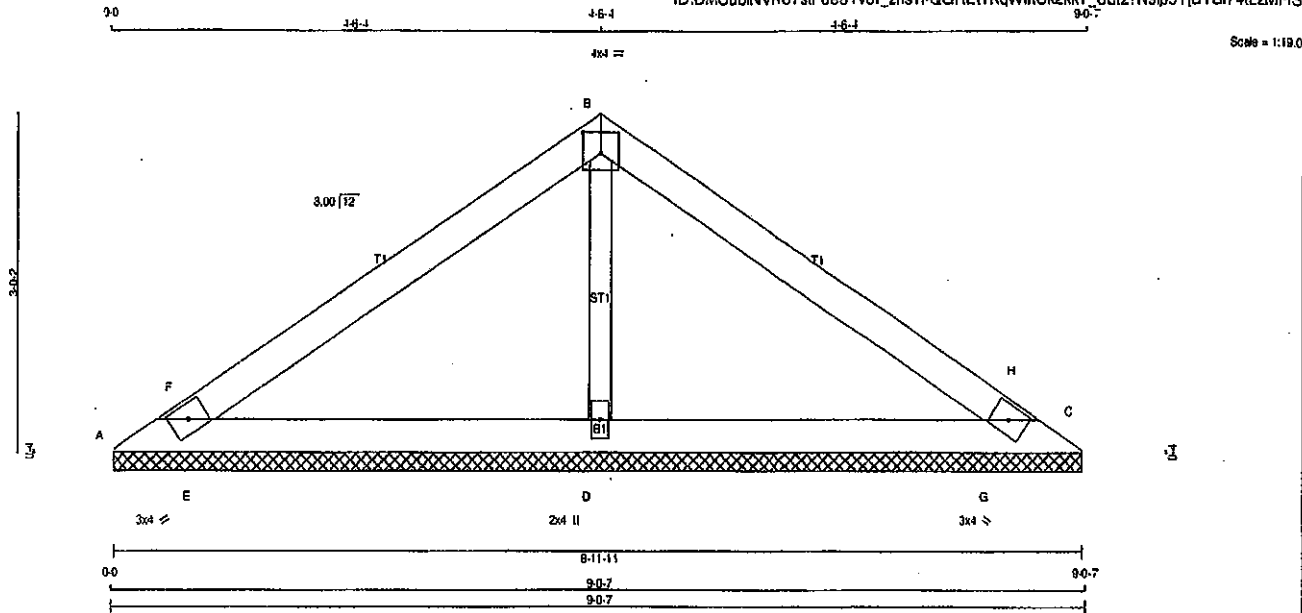

TOTAL WEIGHT = 23 b (M)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF	
B - C	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
A - B	TBM1-h	MT20	3.0	4.0			
B - C	TTW-p	MT20	4.0	4.0	2.25	2.00	
C - B	TBM1-h	MT20	3.0	4.0			
D - B	BMW1-w	MT20	2.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		GROSS REACTION		INPUT		REQD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BRG	BRG
A	49	0	49	0	0	8-11-11	8-11-11		
C	49	0	49	0	0	8-11-11	8-11-11		
D	893	0	893	0	0	8-11-11	8-11-11		

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN.	COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	34	22.0	0.0	0.0	0.0	0.0	12.0	0.0	0.0
C	34	22.0	0.0	0.0	0.0	0.0	12.0	0.0	0.0
D	631	415.0	0.0	0.0	0.0	0.0	216.0	0.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		W EBS		FACTORED	
MEMB.	FORCE	VERY. LOAD	LC1 MAX	MEMB.	FORCE	MAX	LC1
FR-TO	(LBS)	(PLF)	CSI (LC)	UNBRAC	(LBS)	CSI (LC)	
A - F	0 347	-91.8	-91.8 0.12 (1)	10.00	D - B	-698 0	0.12 (1)
F - B	0 341	-91.8	-91.8 0.23 (1)	10.00	E - F	-225 0	0.00 (1)
B - H	0 341	-91.8	-91.8 0.23 (1)	10.00	G - H	-225 0	0.00 (1)
H - C	0 347	-91.8	-91.8 0.12 (1)	10.00			
A - E	-321 0	-18.5	-18.5 0.18 (1)	8.25			
E - D	-290 0	-18.5	-18.5 0.17 (1)	8.25			
D - G	-290 0	-18.5	-18.5 0.17 (1)	8.25			
G - C	-321 0	-18.5	-18.5 0.18 (1)	8.25			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 5.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.23/1.00 (B-F:1), BC=0.17/1.00 (D-E:1), WB=0.12/1.00 (B-D:1), SSI=0.12/1.00 (A-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.260 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.59 (B) (INPUT = 0.90)
JSI METAL= 0.20 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007620

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	PB1	2	1	GREEN PARK HOMES	
Tamareck Roof Truss, Burlington		Version 8.310 S Oct 29 2019 M&T Industries, Inc. Tue Apr 28 09:00:02 2020 Page 1			
		ID:DMCubINVR6TslFoe31v6l zns11-MN1ZkL8C2hoKQ4rIKK5mpuqJiFXyLks?nrjzMFh			
		Scale = 1:16.4			

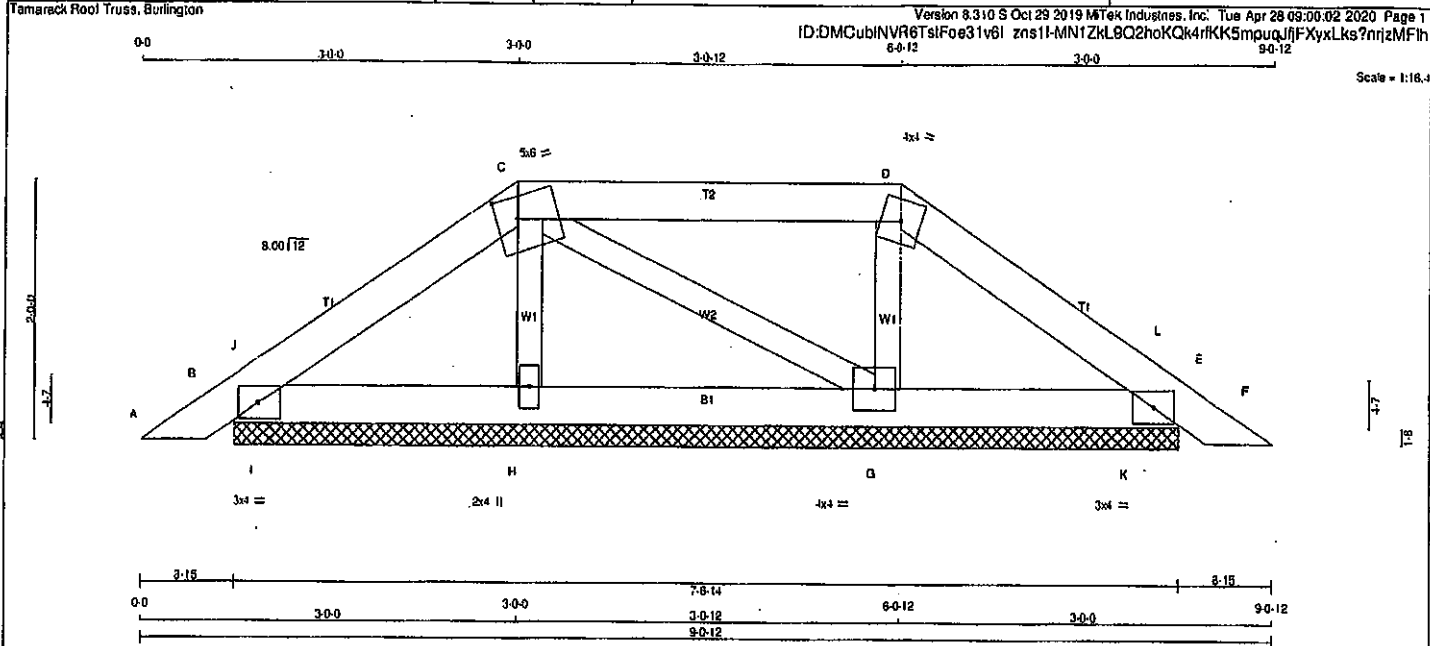

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
B - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TM81-I	MT20	3.0	4.0	
C	TTWW-m	MT20	5.0	6.0	2.00 2.00
D	TTWW-m	MT20	4.0	4.0	
E	TM81-I	MT20	3.0	4.0	
G	BMWW1-I	MT20	4.0	4.0	
H	BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG
B	221	0	221	0	0	0	7-6-14	7-6-14	
E	209	0	209	0	0	0	7-6-14	7-6-14	
H	248	0	248	0	0	0	7-6-14	7-6-14	
G	280	0	280	0	0	0	7-6-14	7-6-14	

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE
B	154	113	0
E	148	106	0
H	178	109	0
G	198	127	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PL)	MAX. (CS) (LC)	MEMB.	FORCE (LBS)	MAX. (CS) (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 15	-91.8	-91.8 0.03 (1)	10.00	H-C	-176 0	0.03 (1)
B-J	-63 0	-91.8	-91.8 0.01 (1)	6.25	C-G	-21 0	0.00 (1)
J-C	-75 0	-91.8	-91.8 0.05 (1)	6.25	G-D	-198 0	0.03 (1)
C-D	-30 0	-91.8	-91.8 0.15 (1)	6.25	I-J	-121 0	0.00 (1)
D-L	-54 0	-91.8	-91.8 0.05 (1)	6.25	K-L	-123 0	0.00 (1)
L-E	-41 0	-91.8	-91.8 0.01 (1)	6.25			
E-F	0 15	-91.8	-91.8 0.03 (1)	10.00			
B-I	0 60	-18.5	-18.5 0.06 (1)	10.00			
I-H	0 60	-18.5	-18.5 0.06 (1)	10.00			
H-G	0 48	-18.5	-18.5 0.03 (1)	10.00			
G-K	0 43	-18.5	-18.5 0.06 (1)	10.00			
K-E	0 43	-18.5	-18.5 0.06 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, NBCC 2015, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS: TC=0.15/1.00 (C-D:1), BC=0.06/1.00 (B-I:1), WB=0.03/1.00 (D-G:1), SS=0.11/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1667
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) INPUT = 0.90
JSI METAL= 0.04 (B) INPUT = 1.00



Structural component only
DWG# T-2007600


JOB NAME 408222	TRUSS NAME PB2	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:00:03 2020 Page 1

ID:DMCubiNVR6TsFoe31v6L_zris1l-qabxxh92p7wB2ul2D2sKJ0C7w31_GPEUzWkKN9zMFig

Scale = 1:18.4

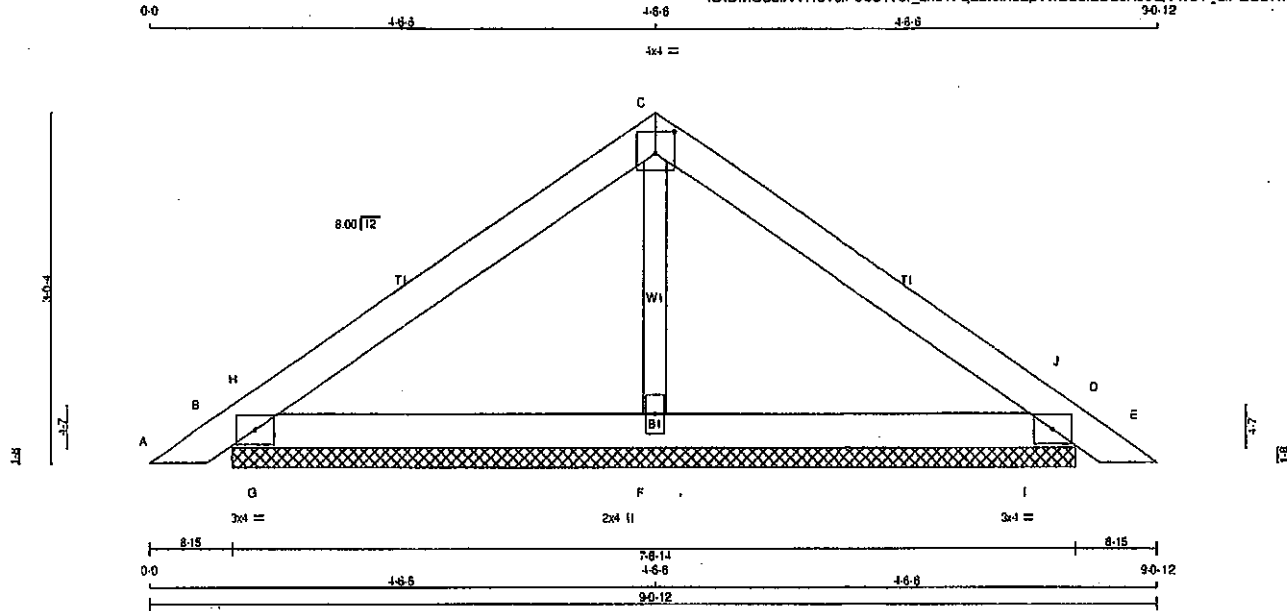

TOTAL WEIGHT = 2 X 23 = 46 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
B - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY; SEASONED LUMBER.					

PLATES (Tablets in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0			
C	TTW-p	MT20	4.0	4.0	2.25	2.00	
D	TMB1-I	MT20	3.0	4.0			
F	BMW1-w	MT20	2.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG
B	318	0	0	318	0	0	0	7-6-14	7-6-14
D	318	0	0	318	0	0	0	7-6-14	7-6-14
F	320	0	0	320	0	0	0	7-6-14	7-6-14

UNFACTORED REACTIONS

JT	1ST LOASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	223	159	0	0	0	0	63	0
D	223	159	0	0	0	0	63	0
F	229	137	0	0	0	0	92	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PL)	MAX. CSI (LC)	MEMB.	MAX. FORCE (LBS)	MAX. CSI (LC)	MAX. CSI (LC)
FR-TO		FROM	TO	FR-TO			
A-B	0 15	-91.8	-91.8 0.03 (1)	10.00	F-C	-148 0	0.03 (1)
B-H	-31 0	-91.8	-91.8 0.07 (1)	8.25	G-H	-349 0	0.00 (1)
H-C	-135 0	-91.8	-91.8 0.16 (1)	6.25	I-J	-349 0	0.00 (1)
C-J	-135 0	-91.8	-91.8 0.16 (1)	6.25			
J-D	-31 0	-91.8	-91.8 0.07 (1)	6.25			
D-E	0 15	-91.8	-91.8 0.03 (1)	10.00			
B-G	0 105	-18.5	-18.5 0.15 (1)	10.00			
G-F	0 105	-18.5	-18.5 0.15 (1)	10.00			
F-I	0 105	-18.5	-18.5 0.15 (1)	10.00			
I-D	0 105	-18.5	-18.5 0.15 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.16:1.00 (C-J:1), BC=0.15:1.00 (F-I:1), WB=0.03:1.00 (C-F:1), SS=0.26:1.00 (D-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.28 (D) INPUT = 0.90
JSI METAL= 0.07 (D) INPUT = 1.00



Structural component only
DWG# T-2007801

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	PB20	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:03:58 2020 Page 1
ID:DMCubINVR6TstFos31v6I zns11-6 jzPKYM7hrKOxBjFY7B9Jg2AAFEry9gNMkIPVzMEMn

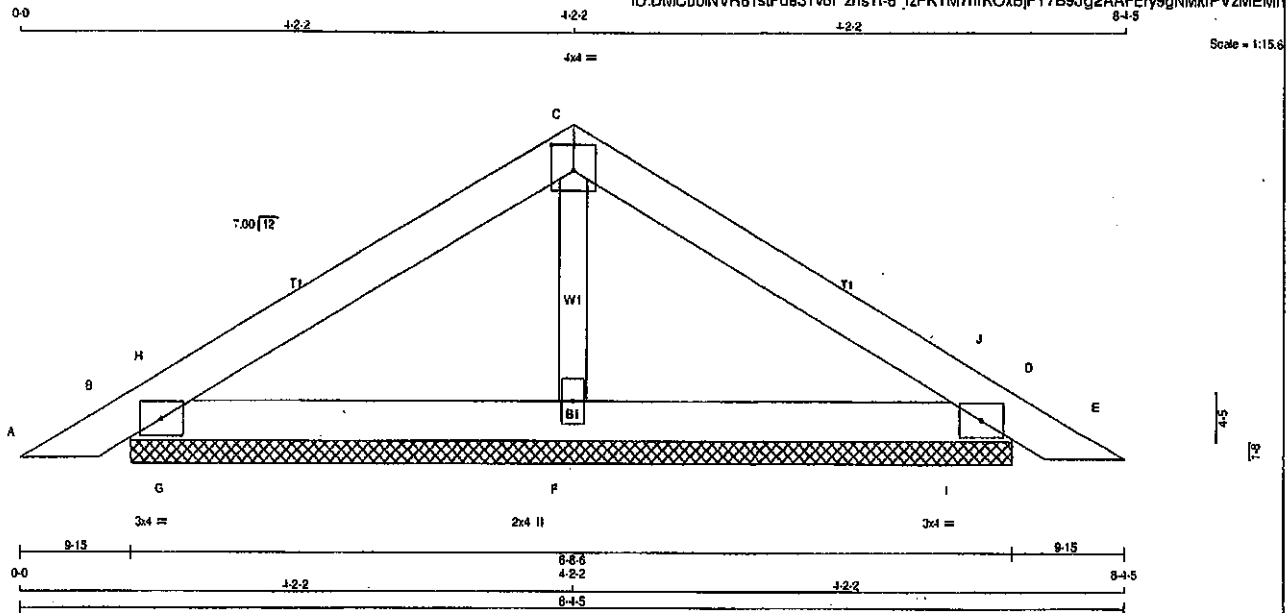

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	SPF
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
B - D	2x4	DRY	No.2	SPF
ALL WEBS 2x3 DRY No.2 SPF				
DRY: SEASONED LUMBER				

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMB1-I	MT20	3.0	4.0
C	TTW-P	MT20	4.0	4.0
D	TMB1-I	MT20	3.0	4.0
F	BMW1+W	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
B	281	0	281	0	0	8-8-8	8-8-8	8-8-8	8-8-8
D	281	0	281	0	0	8-8-8	8-8-8	8-8-8	8-8-8
F	314	0	314	0	0	8-8-8	8-8-8	8-8-8	8-8-8

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
B	197	141	0	0	0	55	0	0
D	197	141	0	0	0	55	0	0
F	224	137	0	0	0	87	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO	LENGTH FR-TO	FR-TO			
A-B	0 16	-91.8 -91.8	0.04 (1)	10.00	F-C	-159 0	0.02 (1)
B-H	-44 0	-91.8 -91.8	0.05 (1)	6.25	G-H	-250 0	0.00 (1)
H-C	-99 0	-91.8 -91.8	0.12 (1)	6.25	I-J	-250 0	0.00 (1)
C-J	-99 0	-91.8 -91.8	0.12 (1)	6.25			
J-D	-44 0	-91.8 -91.8	0.05 (1)	6.25			
D-E	0 16	-91.8 -91.8	0.04 (1)	10.00			
B-G	0 81	-18.5 -18.5	0.12 (1)	10.00			
G-F	0 81	-18.5 -18.5	0.12 (1)	10.00			
F-I	0 81	-18.5 -18.5	0.12 (1)	10.00			
I-D	0 81	-18.5 -18.5	0.12 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (C-H:1), BC=0.12/1.00 (B-G:1), WB=0.02/1.00 (C-F:1), SS=0.18/1.00 (D-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MT20	618	354
	1687	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (D) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007627

JOB NAME 408223	TRUSS NAME PB21	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	----------

Tamrack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:03:57 2020 Page 1

ID:DMCubINVR6TstFoa31v6l zns11-aAGLcfZ u zB05lvpFeQIXDDaZbFaPp0UDxxzMEMm

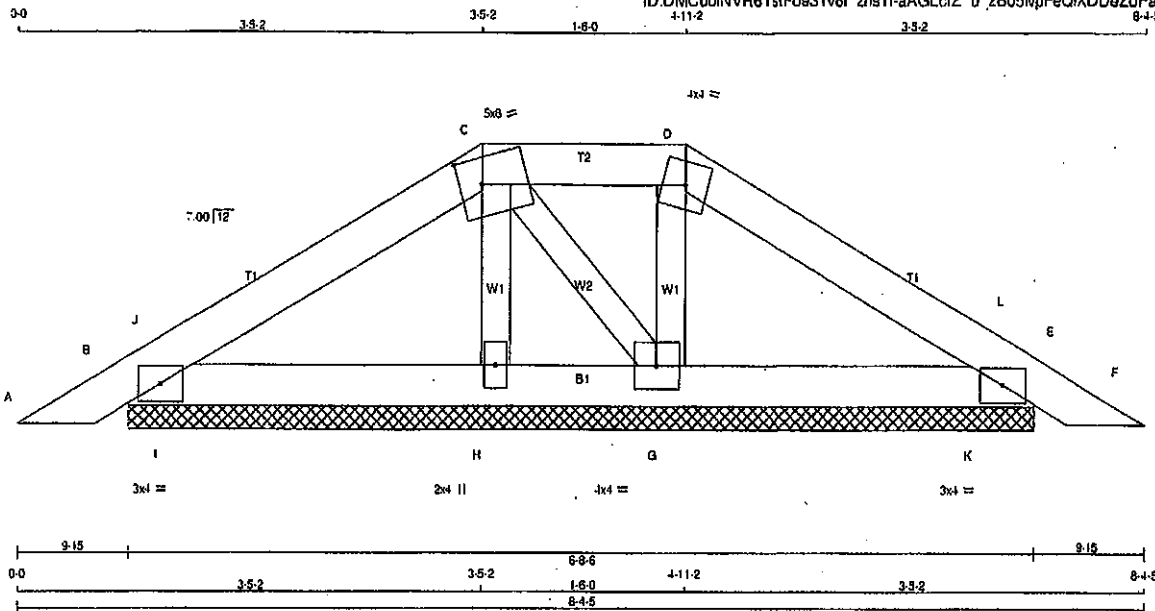

TOTAL WEIGHT = 22 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
B - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
B	241	0	241	0	0	6-8-6	6-8-6
E	228	0	228	0	0	6-8-6	6-8-6
H	170	0	170	0	0	6-8-6	6-8-6
G	238	0	238	0	0	6-8-6	6-8-6

UNFACTORED REACTIONS

1ST LOASE		MAX./MIN. COMPONENT REACTIONS		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	COMBINED	SNOW	LIVE	PERM. LIVE
B	189	121	0	0/0	0/0	48	0	0	0	0	0
E	160	114	0	0/0	0/0	48	0	0	0	0	0
H	122	74	0	0/0	0/0	48	0	0	0	0	0
G	168	111	0	0/0	0/0	57	0	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)	MAX. UNBRAC	CSI (LC)
FR-TO		FROM	TO	FR-TO		LENGTH	FR-TO
A-B	0 18	-91.8	-91.8 0.04 (1)	10.00	H-C	-107 0	0.02 (1)
B-J	-59 0	-91.8	-91.8 0.01 (1)	6.25	C-G	-36 0	0.01 (1)
J-C	-71 0	-91.8	-91.8 0.07 (1)	6.25	G-D	-147 0	0.02 (1)
C-D	-28 0	-91.8	-91.8 0.04 (1)	6.25	I-J	-139 0	0.00 (1)
D-L	-46 0	-91.8	-91.8 0.07 (1)	6.25	K-L	-141 0	0.00 (1)
L-E	-33 0	-91.8	-91.8 0.01 (1)	6.25			
E-F	0 18	-91.8	-91.8 0.04 (1)	10.00			
B-I	0 59	-18.5	-18.5 0.07 (1)	10.00			
I-H	0 59	-18.5	-18.5 0.07 (1)	10.00			
H-G	0 52	-18.5	-18.5 0.04 (1)	10.00			
G-K	0 38	-18.5	-18.5 0.07 (1)	10.00			
K-E	0 38	-18.5	-18.5 0.07 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2019, OBC 2012 : ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA C86-08, CSA C86-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.07/1.00 (D-L:1), SC=0.07/1.00 (B-L:1), WB=0.02/1.00 (D-G:1), SSI=0.11/1.00 (E-K:1)

OOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.19 (B) (INPUT = 0.90)
JSI METAL= 0.05 (D) (INPUT = 1.00)




Structural component only
DWG# T-2007628

JOB NAME 408223	TRUSS NAME PB22	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	---------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 3.310 8 Oct 2019 Mitek Industries, Inc. Tue Apr 28 10:03:58 2020 Page 1

ID:DMCub/NVR6TstFoe31v6l_zrsl1-2Mqjq?acil52eFK5N9IEkmO2zyGJaPzqqDmTNzMEMI

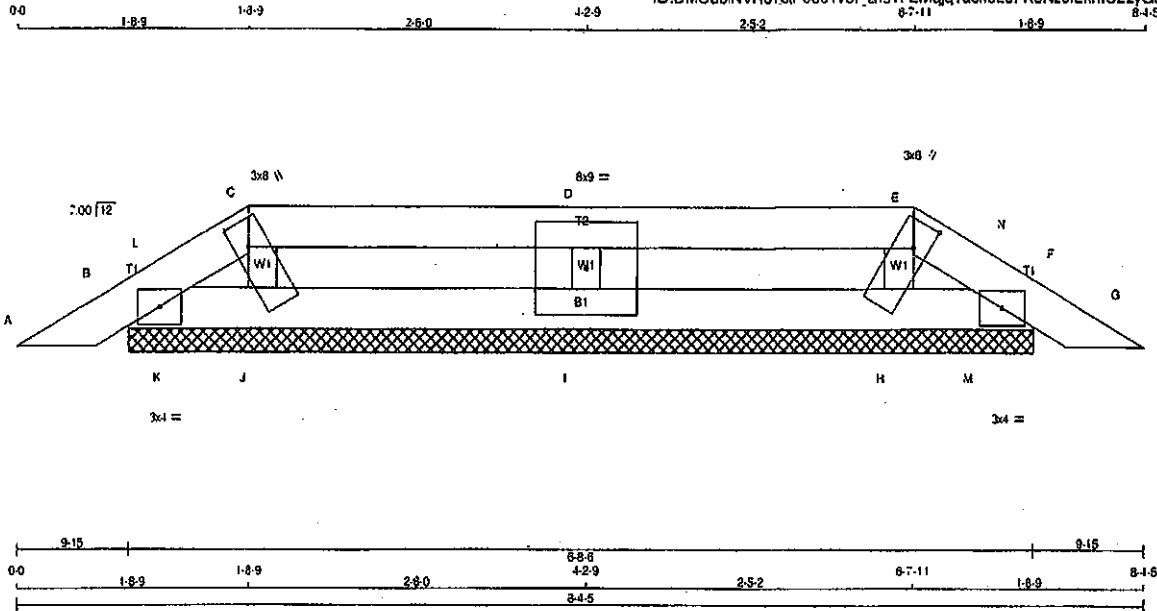

Scale = 1:15.2

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	V X
B	TMB1-I	MT20	3.0	4.0	
C	D, E, H, I, J				
D	TTBW1+H	MT20	3.0	8.0	2.25 1.25
E	TMBW1-I	MT20	8.0	9.0	
F	TTBW1+H	MT20	3.0	8.0	2.25 1.25
G	TMB1-I	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG	IN-SX	IN-SX	
B	151	0	151	0	0	0	0
F	152	0	152	0	0	0	0
J	125	0	125	0	0	0	0
H	120	0	120	0	0	0	0
I	330	0	330	0	0	0	0

UNFACTORED REACTIONS							
JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	105	83	0	0	0	21	0
F	105	83	0	0	0	22	0
J	90	49	0	0	0	41	0
H	86	47	0	0	0	39	0
I	232	158	0	0	0	74	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, F, J, H, I

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 18	-91.8 -91.8 0.04 (1)	10.00	J-C	-95 0	0.01 (1)	
B-L	-53 0	-91.8 -91.8 0.04 (1)	8.25	H-E	-92 0	0.01 (1)	
L-C	-22 0	-91.8 -91.8 0.01 (1)	8.25	I-D	-282 0	0.04 (1)	
C-D	0 3	-91.8 -91.8 0.09 (1)	10.00	K-L	-1 12	0.00 (1)	
D-E	0 3	-91.8 -91.8 0.09 (1)	10.00	M-N	0 13	0.00 (1)	
E-N	-21 0	-91.8 -91.8 0.01 (1)	8.25				
N-F	-52 0	-91.8 -91.8 0.04 (1)	8.25				
F-G	0 18	-91.8 -91.8 0.04 (1)	10.00				
B-K	0 14	-18.5 -18.5 0.01 (1)	10.00				
K-J	0 14	-18.5 -18.5 0.02 (4)	10.00				
J-I	-3 0	-18.5 -18.5 0.02 (4)	10.00				
I-H	-3 0	-18.5 -18.5 0.02 (4)	10.00				
H-M	0 14	-18.5 -18.5 0.01 (4)	10.00				
M-F	0 14	-18.5 -18.5 0.01 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.09/1.00 (D-E:1), BC=0.02/1.00 (I-J:4).
WB=0.04/1.00 (I-J:1), SI=0.11/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.13 (C) (INPUT = 0.90)
JSI METAL = 0.04 (C) (INPUT = 1.00)

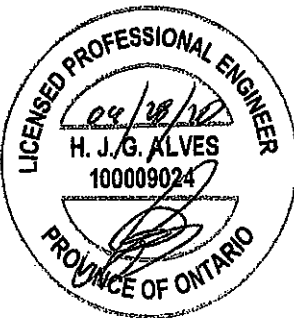

Structural component only
DWG# T-2007629

JOB NAME 408223	TRUSS NAME P20	QUANTITY 17	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

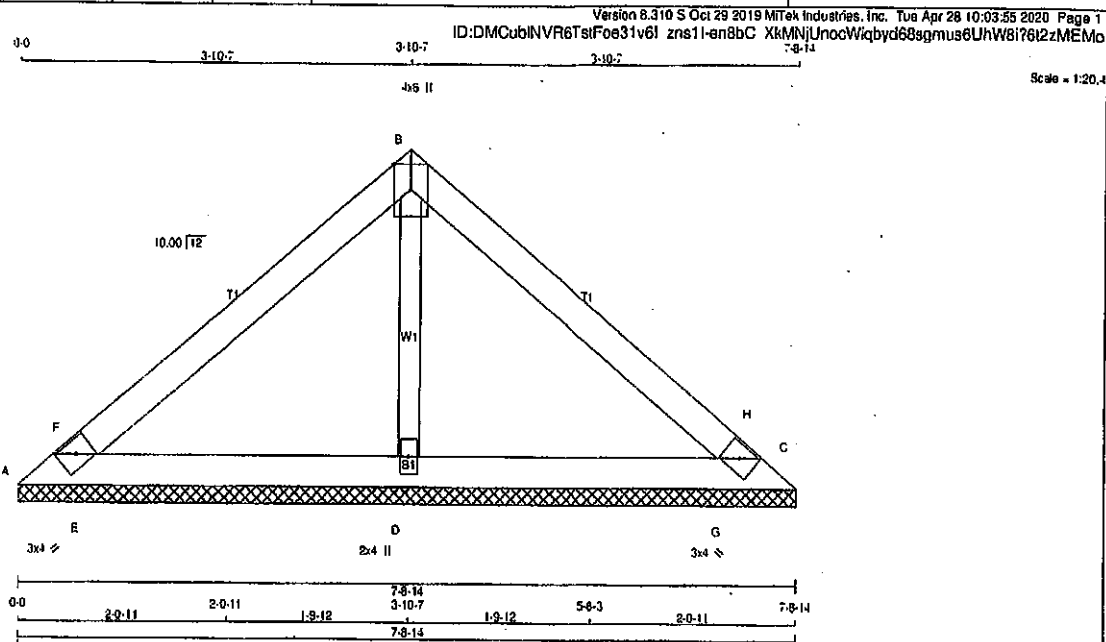

LUMBER			
N. L. G. A. RULES	SIZE	QTY	DESCR.
CHORDS			
A - B	2x4 DRY	No.2	SPF
B - C	2x4 DRY	No.2	SPF
A - C	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TBM1-h	MT20	3.0	4.0	
B	TTW+p	MT20	4.0	6.0	Edge
C	TBM1-h	MT20	3.0	4.0	
D	BMW1-w	MT20	2.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
A	60	0	60	0	0	7-8-14	7-8-14		
C	60	0	60	0	0	7-8-14	7-8-14		
D	733	0	733	0	0	7-8-14	7-8-14		

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	43	28.0	0.0	0.0	0.0	0.0	14.0	0.0
C	42	28.0	0.0	0.0	0.0	0.0	14.0	0.0
D	518	339.0	0.0	0.0	0.0	0.0	179.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. (PLF)	MEMB.	FORCE (LBS)	MAX. (LBS)	MAX. (LBS)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-F	0 227	-91.8	-91.8 0.09 (1)	D-B	-558 0	0.10 (1)	
F-B	0 219	-91.8	-91.8 0.17 (1)	E-F	-199 0	0.00 (1)	
B-H	0 219	-91.8	-91.8 0.17 (1)	G-H	-199 0	0.00 (1)	
H-C	0 228	-91.8	-91.8 0.09 (1)				
A-E	-207 0	-18.5	-18.5 0.13 (1)				
E-D	-174 0	-18.5	-18.5 0.13 (1)				
D-G	-174 0	-18.5	-18.5 0.13 (1)				
G-C	-207 0	-18.5	-18.5 0.13 (1)				

TOTAL WEIGHT = 17 X 21 = 363 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.17 1.00 (B-F:1), BC=0.13/1.00 (D-E:1), WB=0.10/1.00 (B-D:1), SSI=0.11/1.00 (C-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.29 (D) (INPUT = 0.90)
JSI METAL = 0.12 (D) (INPUT = 1.00)




Structural component only
DWG# T-2007626

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	PG20	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:03:59 2020 Page 1

ID:DMCubINVR6TstFoe31v6l zns11-WYO61LaEQcDvFPvHxggunylaUNHa2Js83KzJ0pzMEMk

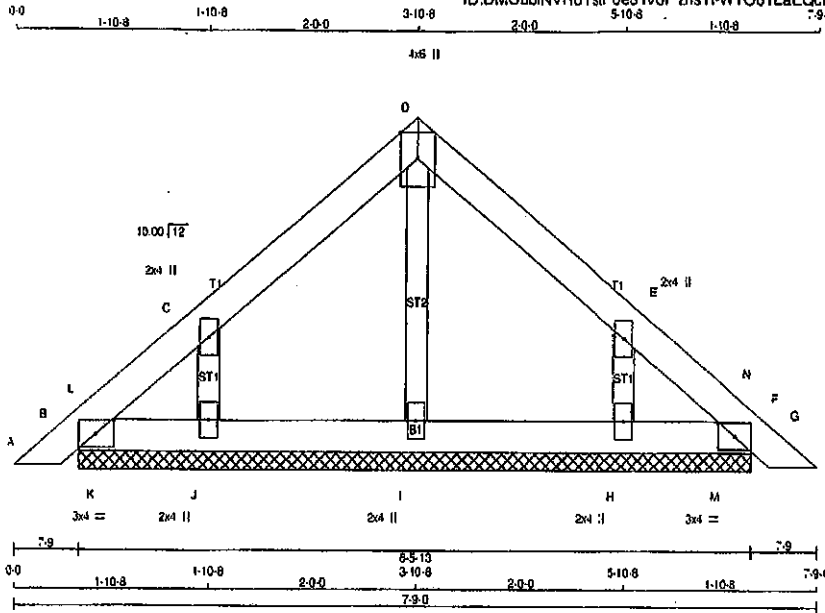

Scale = 1:19.7

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
B - F	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
ALL GABLE WEBS 2x3 DRY No.2			
DRY, SEASONED LUMBER			
GABLE STUDS SPACED AT 2-0-0 OC.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)
FR-TO		FROM TO		FR-TO		FROM TO	
A-B	0 14	-91.8 -91.8 0.02 (1)	10.00	I-D	-111 0	0.02 (1)	
B-L	-71 0	-91.8 -91.8 0.00 (1)	8.25	J-C	-185 0	0.03 (1)	
L-C	-30 0	-91.8 -91.8 0.05 (1)	8.25	H-E	-185 0	0.03 (1)	
C-D	-47 0	-91.8 -91.8 0.05 (1)	8.25	K-L	0 9	0.00 (1)	
D-E	-47 0	-91.8 -91.8 0.05 (1)	8.25	M-N	0 9	0.00 (1)	
E-N	-30 0	-91.8 -91.8 0.05 (1)	8.25				
N-F	-71 0	-91.8 -91.8 0.00 (1)	8.25				
F-G	0 14	-91.8 -91.8 0.02 (1)	10.00				
B-K	0 44	-18.5 -18.5 0.01 (1)	10.00				
K-J	0 44	-18.5 -18.5 0.01 (4)	10.00				
J-I	0 27	-18.5 -18.5 0.02 (4)	10.00				
I-H	0 27	-18.5 -18.5 0.02 (4)	10.00				
H-M	0 44	-18.5 -18.5 0.01 (4)	10.00				
M-F	0 44	-18.5 -18.5 0.01 (1)	10.00				

TOTAL WEIGHT = 2 X 22 = 45 LB

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

SOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019

- PART 9 OF OBC 2012 (2019 AMENDMENT)

- CSA 088-09, CSA 088-14

- TPIC 2011, TPIC 2014

165% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.05/1.00 (C-D:1), BC=0.02/1.00 (H-I:4), WB=0.03/1.00 (G-J:1), SS=0.07/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788
		1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.14 (E) INPUT = 0.80

JSI METAL = 0.10 (C) INPUT = 1.00



Structural component only
DWG# T-2007630

Version 8.310 S Oct 20 2019 MTak Industries, Inc. Tue Apr 28 09:00:01 2020 Page 1



TOTAL WEIGHT = 21 X 17 = 353 lb

JSI GRIP= 0.19 (E) , INPUT = 0.90 ,
JSI METAL= 0.13 (B) , INPUT = 1.00 ,

CHORDS				WEBB			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. CSH (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSH (LC)
FR-TO		FROM TO			FR-TO		
E-B	-161 0	0.0 0.0	0.13 (4)	7.81			
A-B	0 28	-91.8 -91.8	0.12 (1)	10.00			
B-C	-30 0	-91.8 -91.8	0.54 (1)	6.25			
E-D	0 0	-18.5 -18.5	0.13 (4)	10.00			




Structural component only
DWG# T-2007599

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	J20S	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:03:51 2020 Page 1

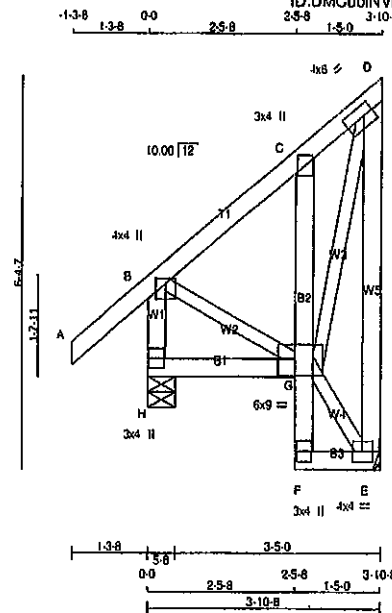

Scale = 1/32"

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR.
H - B	2x4	DRY	No.2	SPF
A - D	2x4	DRY	No.2	SPF
H - G	2x4	DRY	No.2	SPF
F - C	2x4	DRY	No.2	SPF
F - E	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
E - O	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TMV+p	MT20	3.0	4.0		
D	TMVW-l	MT20	4.0	8.0	2.00	2.00
E	BMVW-l	MT20	4.0	4.0		
F	BMV+p	MT20	3.0	4.0		
G	BMVW-l	MT20	6.0	8.0	3.25	3.50
H	BMV+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
H	333	0	333	0	5-8
E	208	0	208	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	233	166	0	0	0	0	87	0
E	145	95	0	0	0	0	50	0

BEARING MATERIAL TO BE SPF NO. 2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)
H-B	-309	0	0.0	0.03 (1)	7.81
A-B	0	41	-91.8	-91.8	0.14 (5)
B-C	-70	0	-91.8	-91.8	0.07 (1)
C-D	-92	0	-91.8	-91.8	0.06 (1)
H-G	0	0	-18.5	-18.5	0.04 (4)
F-G	0	12	0.0	0.0	0.02 (1)
G-C	-216	0	0.0	0.0	0.02 (1)
F-E	0	8	-18.5	-18.5	0.01 (4)

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:	
TOP CH.	LL = 25.6 PSF
DL	= 6.0 PSF
BOT CH.	LL = 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/989 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.14/1.00 (A-B-5), BC=0.04/1.00 (G-H-4), WB=0.09/1.00 (D-E-1), SS=0.09/1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MT20	618	354
	1687	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (B) (INPUT = 0.90)
JSI METAL = 0.08 (C) (INPUT = 1.00)

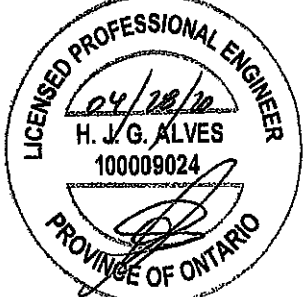

Structural component only
DWG# T-2007623



TOTAL WEIGHT = 4 X 12 = 49 lb

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0		

	FACTORED		MAXIMUM FACTORED		INPUT	REQD
	GROSS REACTION		GROSS REACTION		BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX
C	175	0	175	0	1-8	1-8
B	385	0	385	0	5-8	5-8
D	67	0	67	0	1-8	1-8

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
C	121	94 0	0 0	0 0	0 0	27 0	0 0
B	258	181 0	0 0	0 0	0 0	75 0	0 0
D	50	18 0	0 0	0 0	0 0	32 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO		FR-TO			
A-B	0 23	-91.8 -91.8	0.12 (1)	10.00	E-F	235 7	0.00 (1)
B-F	-17 13	-91.8 -91.8	0.04 (4)	6.25			
F-C	1 2	-91.8 -91.8	0.23 (1)	10.00			
B-E	0 0	-18.5 -18.5	0.16 (1)	10.00			
E-D	0 0	-18.5 -18.5	0.16 (1)	10.00			

SPECIFIED LOADS:			
TOP CH.	LL	=	25.6 PSF
	DL	=	8.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.4 PSF
TOTAL LOAD		=	39.0 PSF

SPACING 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L380 (0.19")
CALCULATED VERT. DEFL.(LL) = L'999 (0.02")
ALLOWABLE DEFL.(TL) = L380 (0.19")
CALCULATED VERT. DEFL.(TL) = L'999 (0.05")

CSI: TC=0.23/1.00 (C-F:1), BC=0.18/1.00 (D-E:1),
WB=0.00/1.00 (E-F:1), SS=0.19/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)	(PSI)	(PLI)	(PLI)	(PLI)	(PLI)
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1867	788	1987	1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.26 (B) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007624

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	J22	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:03:54 2020 Page 1

ID:DMCubINVR6TstFoe31v6l zns1l-AbaD eX6b3bd9e1K874j4ubg(MZPN21Nv2FYKczMEMp

Scale = 1:27.0

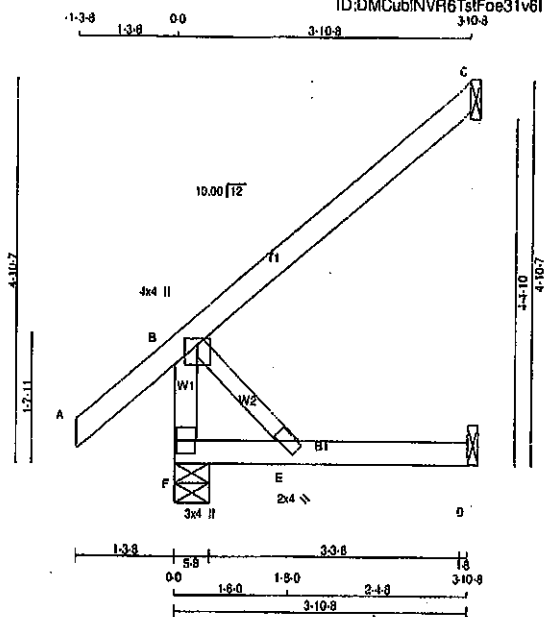

TOTAL WEIGHT = 3 X 15 = 45 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	No.2
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
F	341	0	341	0	0	5-8	5-8
C	178	0	178	0	0	1-8	1-8
D	36	0	40	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97781H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	239	170	0	0	0	89	0
C	122	98	0	0	0	23	0
D	29	0	0	0	0	29	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
F-B	-305	B-E	0
A-B	0		
B-C	0		
F-E	0		
E-D	0		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPC 2011, TPC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.23/1.00 (B-C:1), BC=0.08/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (8) (INPUT = 0.90)
JSI METAL = 0.08 (8) (INPUT = 1.00)

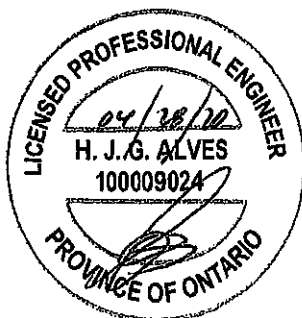


Structural component only
DWG# T-2007625

JOB NAME 408224	TRUSS NAME J40	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:19:52 2020 Page 1
ID:DMCubINVR6TstFoe31v6I zns11-6uTN2C71 PHn5sGSGJGMvwHM_XXOqKBNC5JFy4zME7r

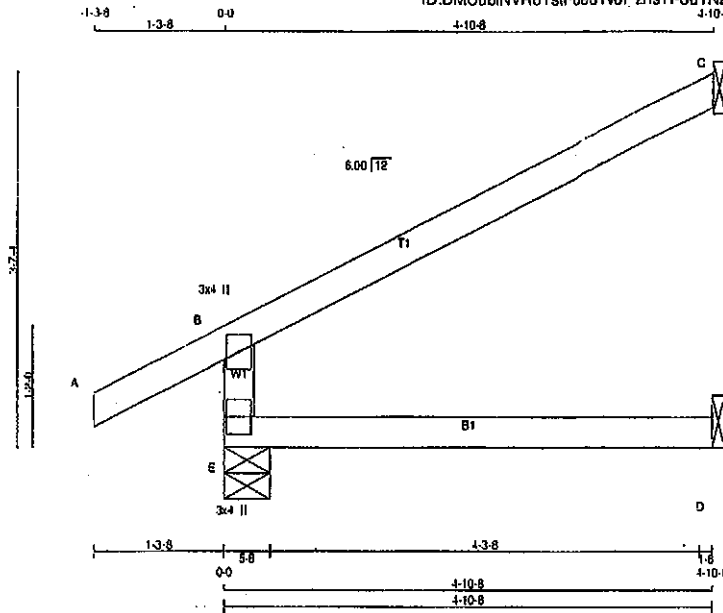

Scale = 1:20.0

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2	
A - C	2x4	DRY	No.2	
E - D	2x4	DRY	No.2	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0			
E	BMV1+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING DESIGNER							
<u>BEARINGS</u>							
JT	FACTORED		MAXIMUM FACTORED		INPUT	REQRD	
	GROSS REACTION		GROSS REACTION				
	VERT	HORZ	DOWN	HORZ	BRG	BRG	
E	456	0	456	0	IN-SX <td>IN-SX</td>	IN-SX	
C	168	0	168	0	5-8	5-8	
D	38	0	42	0	1-8	1-8	
					1-8	1-8	

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE		MAX. MIN. COMPONENT REACTIONS		PERM. LIVE	WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE				
E	320	225	0	0.0	0.0	0.0	95	0.0
C	116	94	0	0.0	0.0	0.0	22	0.0
D	30	0	0	0.0	0.0	0.0	30	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		WEBS		FACTORED	
	MAX. FORCE (LBS)	VERT. LOAD (PLF)	MAX. FORCE (LBS)	VERT. LOAD (PLF)	MAX. FORCE (LBS)	VERT. LOAD (PLF)	MAX. FORCE (LBS)	VERT. LOAD (PLF)
FR-TO								
E-B	-404	0	0.0	0.0	0.08	(4)	7.81	
A-B	0	28	-91.8	-91.8	0.12	(1)	10.00	
B-C	-25	0	-91.8	-91.8	0.37	(1)	6.25	
E-D	0	0	-18.5	-18.5	0.09	(4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPC 2011, TPC 2014

DESIGN ASSUMPTIONS
OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19')
CALCULATED VERT. DEFL.(LL) = L/999 (0.00')
ALLOWABLE DEFL.(TL) = L/360 (0.19')
CALCULATED VERT. DEFL.(TL) = L/999 (0.02')

CSI: TC=0.37 1.00 (B-C:1), BC=0.09/1.00 (D-E:4), WB=0.00/1.00 (na:0), SSI=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

MAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSB) (PLB) (PLB)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.17 (E) (INPUT = 0.90)
JSI METAL = 0.11 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007657

JOB NAME 408224	TRUSS NAME J41	QUANTITY 5	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Tamarack Roof Truss, Burlington

ID:DMCubINVR6TsFoa31v6I zns11-3Hb7Tu8HW1XPKAQqNkQ LmMiLEmIEngIPoM1zzME7p

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:19:54 2020 Page 1

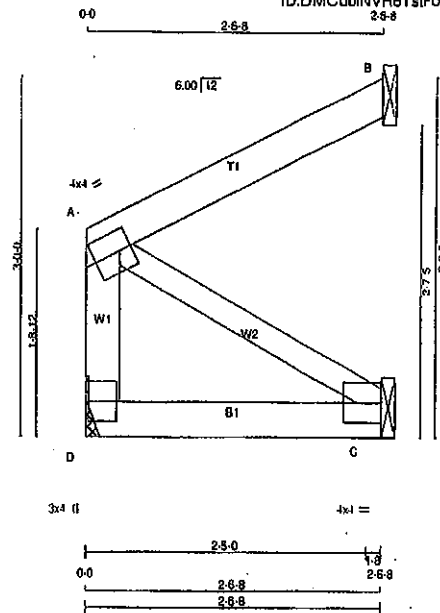

Scale = 1:17.8

LUMBER	DESCR.
N. L. G. A. RULES	
CHORDS SIZE	
D - A 2x4 DRY No.2	SPF
A - B 2x4 DRY No.2	SPF
D - C 2x4 DRY No.2	SPF
ALL WEBS 2x3 DRY No.2	SPF
DRY: SEASONED LUMBER.	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	DOWN	HORIZ	UPLIFT
D 139 0	139 0	0 0	MECHANICAL
B 117 0	117 0	0 0	1-8
C 23 0	25 0	0 0	1-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
D 98 65 0 0.0 0 0 33 0 -0 0	
B 80 65 0 0.0 0 0 15 0 0 0	
C 18 0 0 0.0 0 0 18 0 0 0	

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)
FR-TO					FR-TO			
D-A	-117 0	0.0	0.0	0.01 (1)	7.81	A-C	0 0	0.00 (1)
A-B	0 0	-91.8	-91.8	0.10 (1)	10.00			
D-C	0 0	-18.5	-18.5	0.03 (4)	10.00			

TOTAL WEIGHT = 5 X 10 = 49 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEF. (TL) = L/360 (0.19")
CALCULATED VERT. DEF. (TL) = L/999 (0.00")

CS: TC=0.10/1.00 (A-B:1), BC=0.03/1.00 (C-D:1), WB=0.00/1.00 (A-C:1), BS=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.07 (A) (INPUT = 0.90)
JSI METAL = 0.02 (A) (INPUT = 1.00)




Structural component only
DWG# T-2007658

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	J42	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:55 2020 Page 1

ID:DMCubINVR6TstFoe31v6l znsH-Xt8WgE9vHKIGyK?1xSq3XYumIX 1hxqu3YvZPzME7c

Scale = 1:22.9

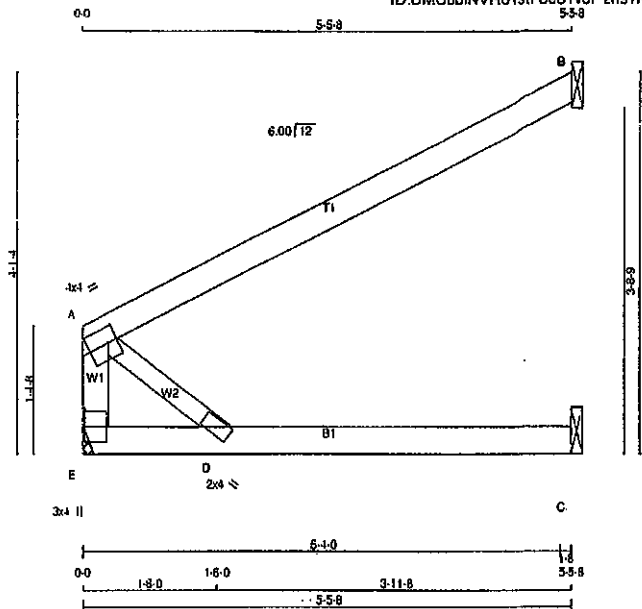

TOTAL WEIGHT = 2 X 16 = 31 lb

[M][F]

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - A	2x4	DRY	No.2
A - B	2x4	DRY	No.2
E - C	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

DESCR.
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQ'D BRG
JT	VERT	HORZ	DOWN	HORZ
E	381	0	301	0
B	250	0	250	0
C	50	0	57	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	213	140	0	0	0	73	0
B	172	140	0	0	0	33	0
C	40	0	0	0	0	40	0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO		FR-TO			
E-A	250	0	0.0	A-D	0	0.0	(1)
A-B	0	0	-91.8				
			-91.8				
E-D	0	0	-18.5				
D-C	0	0	-18.5				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19')
CALCULATED VERT. DEFL.(LL) = L/999 (0.00')
ALLOWABLE DEFL.(TL) = L/360 (0.19')
CALCULATED VERT. DEFL.(TL) = L/999 (0.04')

CSI: TC=0.45/1.00 (A-B:1), BC=0.16/1.00 (C-D:1), WB=0.00/1.00 (A-D:1), SSI=0.17/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1937 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.15 (A) (INPUT = 0.90)
JSI METAL = 0.04 (A) (INPUT = 1.00)



Structural component only
DWG# T-2007659

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C40	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:19:42 2020 Page 1					
ID:DMCubINVR6TslFoe31v6I zns11-Pzsbyo7ILL16uKVXgD50VpshpV5QUojwXui0izME8?					
Scale = 1:17.9					

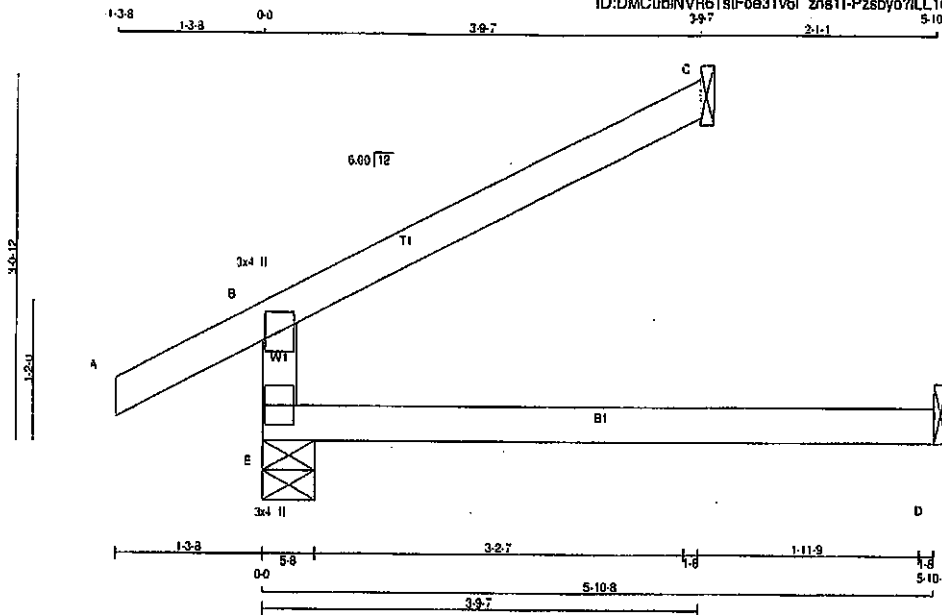

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4 DRY	No.2	SPF
A - C	2x4 DRY	No.2	SPF
E - D	2x4 DRY	No.2	SPF
DRY, SEASONED LUMBER.			

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
E	405	0	405	0	5-8	5-8
C	130	0	130	0	1-8	1-8
D	45	0	50	0	1-8	1-8

SEE MTEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

JT	UNFACTORED REACTIONS		MAX. MIN. COMPONENT REACTIONS		DEAD	SOIL
	1ST LOASE	SNOW	LIVE	PERM. LIVE		
E	285	190	0	0	98	0
C	90	73	0	0	17	0
D	36	0	0	0	36	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		WEBS		FACTORED	
	MAX. FORCE	VERT. LOAD	MAX. (PLF)	MAX. (LC)	MAX. UNBRAC LENGTH	MEMB. FORCE	MAX. (LBS)	MAX. (LC)
FR-TO								
E-B	-342	0	0.0	0.0	0.13 (4)	7.81		
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00		
B-C	-19	0	-91.8	-91.8	0.22 (1)	6.25		
E-D	0	0	-18.5	-18.5	0.13 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.22/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (m/a:0), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1687
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.14 (E), INPUT = 0.90)
JSI METAL=0.09 (B), INPUT = 1.00)

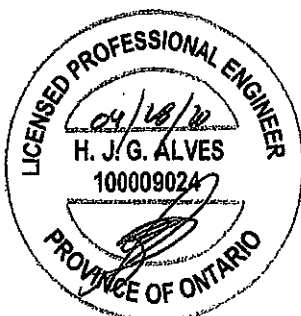


Structural component only
DWG# T-2007648

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C41	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:44 2020 Page 1
ID:DMCubINVR6TstFoe3iv6l zns11-LM MNT0?tyHq7dVoe7UaEx3uJnoyDCMrNgYzME7z
5-10-8

Scale = 1:13.1

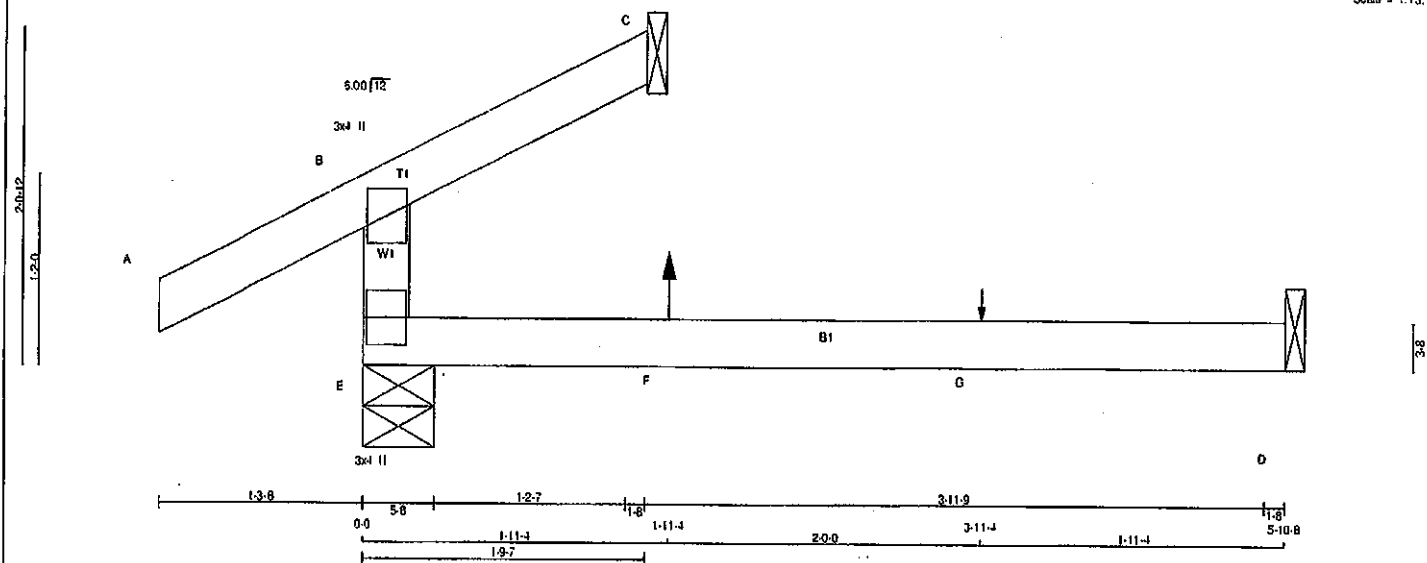

TOTAL WEIGHT = 2 X 12 = 23 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	ORY	No.2
A - C	2x4	ORY	No.2
E - D	2x4	ORY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED	MAXIMUM FACTORED	INPUT	RECORD			
	GROSS REACTION	GROSS REACTION	BRG	BRG			
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	284	0	284	0	0	5-8	5-8
C	63	0	63	0	0	1-8	1-8
D	44	0	52	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
	1ST CASE	MAX. MIN.	COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	200	137	0	0	0	62	0
C	46	21	0	0	0	25	0
D	35	0	3	0	0	37	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (7)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX. FACTORED	MEMB.	MAX. FACTORED
	FORCE	VERT. LOAD	LC1	MAX. FACTORED	FORCE		MAX. FACTORED
	(LBS)	(PLF)	CSI (LG)	UNBRAC	(LBS)		CSI (LC)
FR-TO	FROM	TO	LENGTH	FR-TO			
E-B	-227	0	0.0	0.0	11	(4)	7.81
A-B	0	28	-91.8	-91.8	0.12	(11)	10.00
B-C	-9	9	-91.8	-91.8	0.08	(4)	10.00
E-F	0	0	-18.5	-18.5	0.14	(4)	10.00
F-G	0	0	-18.5	-18.5	0.14	(4)	10.00
G-D	0	0	-18.5	-18.5	0.14	(4)	10.00

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE
F	1-11-4	7	1	12	BACK	VERT	TOTAL
G	3-11-4	1	1	1	BACK	VERT	TOTAL

CONNECTION REQUIREMENTS

II C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/G

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4),
WB=0.00/1.00 (N/A:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=0.98 NAIL=0.98 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 789 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (E) INPUT = 0.80 ;
JSI METAL = 0.06 (B) INPUT = 1.00 ;



Structural component only
DWG# T-2007649


JOB NAME 408224	TRUSS NAME C42	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITEK Industries, Inc. Tue Apr 28 10:19:45 2020 Page 1

ID:DMCubNVR6TsIF0e31v6I zns11-pYYkapleeGPhnE6LLej7RUC2j9wh8SMbV7NC zME7y

Scale = 1:18.2

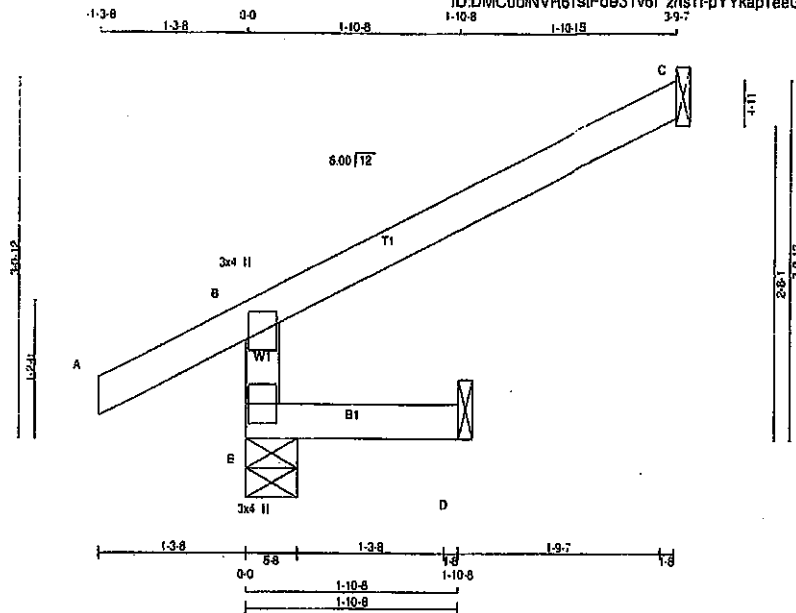

LUMBER	N.L.G.A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2	
A - C	2x4	DRY	No.2	
E - D	2x4	DRY	No.2	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	V	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

REACTIONS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UP	IN-SX
E	381	0	0	5-8
C	130	0	0	1-8
D	16	0	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
E	250	190	0	0	0
C	90	73	0	0	0
D	12	0.0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD	MEMB.	FORCE
	(LBS)	(PLF)		(LBS)
FR-TO		FROM TO	LENGTH FR-TO	
E-B	-342	0	0.0	0.01 (4)
A-B	0	28	-81.8	-81.8 0.13 (5)
B-C	-19	0	-81.8	-81.8 0.22 (1)
E-D	0	0	-18.5	-18.5 0.02 (4)

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.8	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 066-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/989 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/989 (0.00")

CSI: TC=0.22(1.00) (B-C:1), BC=0.02(1.00) (D-E:4),
WB=0.00(1.00) (m/g:0), SSI=0.15(1.00) (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	818	354	1687

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.14 (E) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007650

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C43	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:46 2020 Page 1
ID:DMCubINVR6TstFoe31vbl_zns1l-k66o92GPaxYNxplv39yft1OQ6VqQdVq9sxlRzME7x

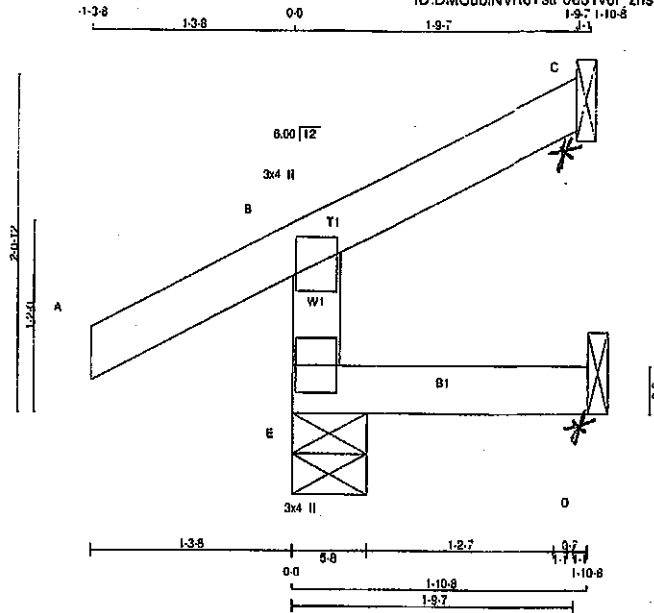

Scale = 1/13.1

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
E - B	2x4	DRY No.2
A - C	2x4	DRY No.2
E - D	2x4	DRY No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	RECORD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	271	0	271	0	5.8	5.8
C	45	0	45	0	1.8	1.8
D	8	0	17	0	1.8	1.8

SEE MITEK STANDARD DETAIL B87791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX. MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	188	141	0	0.0	0.0	47.0	0.0
C	31	24	-18	0.0	0.0	7.0	0.0
D	7	0	-8	0.0	0.0	12.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED MAX. CSI (LC)		MEMB. UNBRACED LENGTH FR-TO	WEBS MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
			FROM	TO			
E-B	-244	0	0.0	0.0	0.04 (5)	7.61	
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00	
B-C	-17	0	-91.8	-91.8	0.09 (1)	6.25	
E-D	0	0	-18.5	-18.5	0.04 (5)	10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19')
CALCULATED VERT. DEFL.(LL) = L/999 (0.00')
ALLOWABLE DEFL.(TL) = L/360 (0.19')
CALCULATED VERT. DEFL.(TL) = L/999 (0.00')

CSI: TC=0.12(1.00 (A-B:1) , BC=0.04(1.00 (D-E:5) , WB=0.00(1.00 (Ina:2) , SSI=0.09(1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(ORY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354
	1687	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (E) INPUT = 0.90)
JSI METAL= 0.07 (B) INPUT = 1.00)



Structural component only
DWG# T-2007651

JOB NAME 408224	TRUSS NAME C44	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

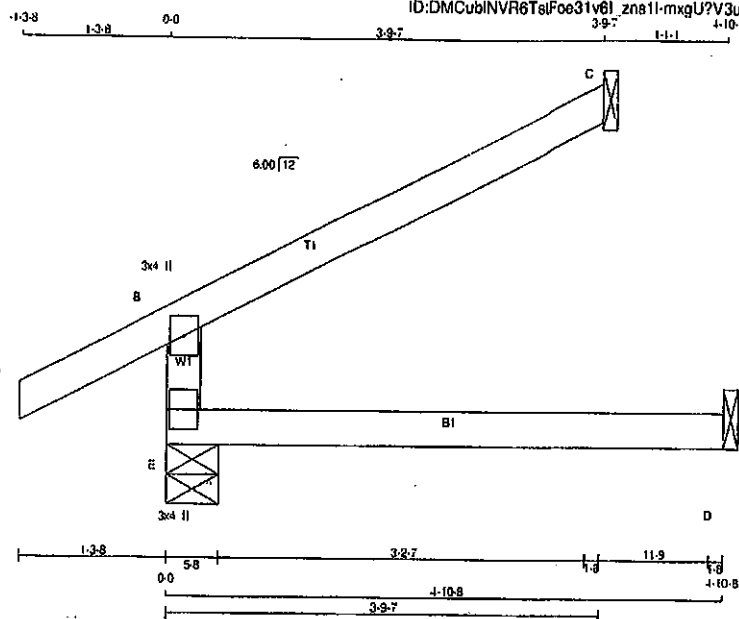

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

DESCR.	SPF	BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
		GROSS REACTION	HORZ	GROSS REACTION	HORZ	GROSS REACTION	HORZ	BRG	IN-SX	BRG	IN-SX
JT		394	0	394	0	394	0	5.8	5.8	5.8	5.8
E		130	0	130	0	130	0	1.8	1.8	1.8	1.8
C		38	0	42	0	42	0	1.8	1.8	1.8	1.8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

JT	COMBINED	MAX. MIN. COMPONENT REACTIONS					
		1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD
E	277	190	0	0.0	0.0	0.0	87.0
C	90	73.0	0	0.0	0.0	0.0	17.0
D	30	0.0	0.0	0.0	0.0	0.0	30.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED	FORCE (LBS)	VERT. LOAD	LC1	MAX (PLF)	CSI (LC)	UNBRACED LENGTH	FR-TO	MEMB.	MAX. FACTORED	FORCE (LBS)	MAX (PLF)	CSI (LC)
E-B		-342	0	0.0	0.0	0.08 (4)	7.81							
A-B		0	28	-91.8	-91.8	0.12 (1)	10.00							
B-C		-19	0	-91.8	-91.8	0.22 (1)	8.25							
E-D		0	0	-18.5	-18.5	0.08 (4)	10.00							

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.22 (1.00 (B-C:1), BC=0.09 (1.00 (D-E:4), WB=0.00 (1.00 (A-B:2), SSI=0.15 (1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSD) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.14 (E) INPUT = 0.90
JSI METAL = 0.09 (B) INPUT = 1.00

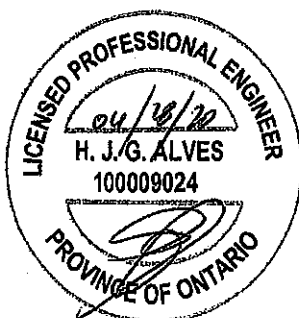


Structural component only
DWG# T-2007652

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C45	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 16:19:48 2020 Page 1

ID:DMCubINVr6TslFoe31v6I_zns1t-E7DsCr3WxBnFcFygl1UCQ48kwwAMuWC0HTLtpJzME7v

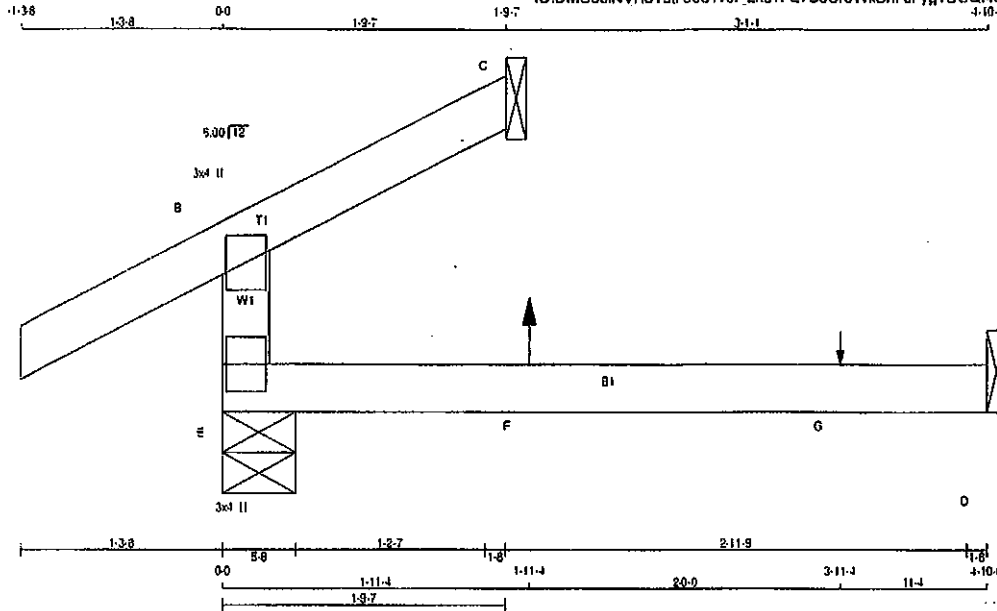

Scale = 1/16"

TOTAL WEIGHT = 2 X 10 = 21 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

SPF

DESCR.

SPF

SPF

SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y
B	TMV+p	MT20	3.0	4.0	X
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
FACTORED				MAXIMUM FACTORED		INPUT	
GROSS REACTION				DOWN		BRG	
JT	VERT	HORZ	UP/LIFT	DOWN	HORZ	BRG	IN-SX
E	282	0	0	282	0	5-8	5-8
C	55	0	0	55	0	1-8	1-8
D	35	0	0	44	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
1ST CASE				MAX. MIN. COMPONENT REACTIONS			
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	198	137	0	0	0	81	0
C	39	21	0	0	0	18	0
D	29	0	4	0	0	31	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (7)

CHORDS				WEBS			
MEMB.		FACTORED		MEMB.		FACTORED	
FORCE		VERT. LOAD		FORCE		MAX.	
(LBS)		(PLF)		(LBS)		CSI (LC)	
FR-TO		FROM TO		FR-TO		LENGTH	
E-B	-235 0	0.0	0.0 0.07 (4)	7.81			
A-B	0 28	-91.8	-91.8 0.12 (11)	10.00			
B-C	-13 5	-91.8	-91.8 0.07 (5)	6.25			
E-F	0 0	-18.5	-18.5 0.10 (4)	10.00			
F-G	0 0	-18.5	-18.5 0.10 (4)	10.00			
G-D	0 0	-18.5	-18.5 0.10 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
F	1-11-4	7	1	12	BACK	VERT	TOTAL	---	C1
G	3-11-4	1	1	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.02")

CSI: TC=0.12/1.00 (A-B:1) . BC=0.10/1.00 (D-E:4) .
WB=0.00/1.00 (m:30) . SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007653

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C46	1	1	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:49 2020 Page 1
ID:DMCubINVR6TslFoe31v6I zns1I-iJnEQB48hUv6EPXla8jHhHfukKVjdSxW75bLzME7U

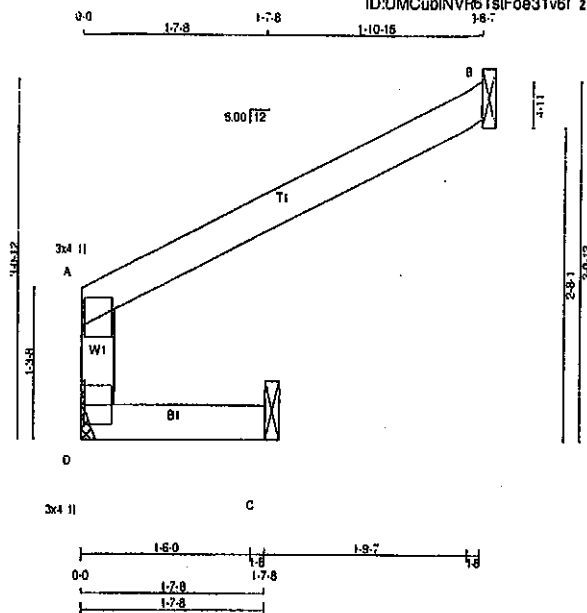

Scale = 1:18.2

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
D - A	2x4	ORY	No.2
A - B	2x4	ORY	No.2
D - C	2x4	ORY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMV+p	MT20	3.0	4.0
D	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	BRG	IN-SX	IN-SX
D	156	0	156	0	0	MECHANICAL			
B	144	0	144	0	0	1-8	1-8		
C	55	0	55	0	0	1-8	1-8		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS		1ST LCASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
D	109	78 0	0 0	0 0	0 0
B	99	80 0	0 0	0 0	0 0
C	40	23 0	0 0	0 0	0 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	FORCE (LBS)	VERT. LOAD LC1	MAX. (PLF)	MEMB.	MAX. FORCE (LBS)
FR-TO				FR-TO	
D-A	-181 0	0.0	0.0 0.09 (1)		
A-B	-8 0	-91.8	-91.8 0.14 (1)		
D-C	0 0	-18.5	-18.5 0.09 (1)		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2010
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19')
CALCULATED VERT. DEFL.(LL) = L/999 (0.00')
ALLOWABLE DEFL.(TL) = L/360 (0.19')
CALCULATED VERT. DEFL.(TL) = L/999 (0.00')

CSI: TC=0.14/1.00 (A-B:1), BC=0.09/1.00 (C-D:1),
WB=0.00/1.00 (max:0), SSI=0.13/1.00 (A-B:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.08 (D) INPUT = 0.90 1
JSI METAL= 0.05 (A) INPUT = 1.00 1



Structural component only
DWG# T-2007654

JOB NAME 408224	TRUSS NAME C47	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:50 2020 Page 1
ID:DMCubINVR6TslFoe31v8f zns11-AWLddX5mSo1zrY638uEuqVB5aks7MQi5knq8uCzME7

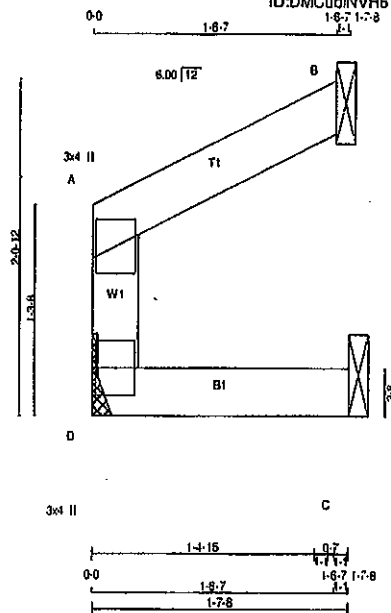

Scale = 1:13.1

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
D - A	2x4	DRY	No.2
A - B	2x4	DRY	No.2
D - C	2x4	DRY	No.2

DRY, SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMV+p	MT20	3.0	4.0
D	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
D	88	0	88	0	0	MECHANICAL			
B	87	0	87	0	0	1-8	1-8		
C	19	0	19	0	0	1-8	1-8		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS							
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
D	61	39	0	0	0	21	0	0	0
B	46	37	0	0	0	9	0	0	0
C	14	2	0	0	0	12	0	0	0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)	MAX. FACTORED	CS1 (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
D-A	-74	0	0.0	0.0	0.01 (1)	7.81	
A-B	-2	0	-91.8	-91.8	0.03 (1)	10.00	
D-C	0	0	-18.5	-18.5	0.01 (4)	10.00	

TOTAL WEIGHT = 5 b (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CS1: TC=0.03:1.00 (A-B:1), BC=0.01:1.00 (C-D:4), WB=0.00:1.00 (in a:0), SS1=0.05:1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX	MIN	MAX
MT20	618	354
	1697	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.03 (D), INPUT = 0.90
JSI METAL = 0.02 (A), INPUT = 1.00



Structural component only
DWG# T-2007655

LUL/LUS/LJS/HUS/HHUS/HGUS

SIMPSON
Strong-Tie

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.

Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:

- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options Information on p. 126.




Double-Shear
Nailing
Top View




Double-Shear
Nailing
Side View;
Do not
bend tab




Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,560

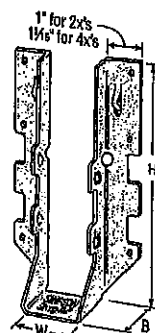


✓ LUS28




LU26L

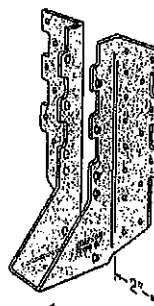


✓ HUS210
(HUS26, HUS28,
and HHUS similar)



✓ HGUS28-2




✓ HHUS210-2



LJS26DS

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

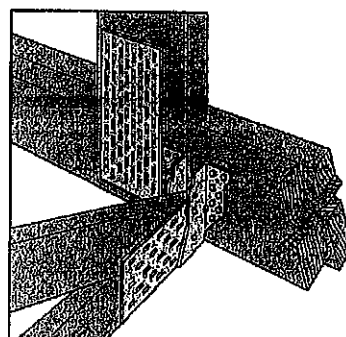

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options Information on pp. 125–127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
W < 2"	Bevel or square cut	0.62 of table value	0.46 of table value
2" < W < 6"	Bevel cut	0.67 of table value	0.41 of table value
2" < W < 6"	Square cut	0.46 of table value	0.41 of table value
W > 6"	Bevel cut	0.75 of table value	0.41 of table value

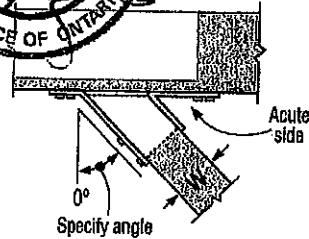

**Top View HHUS Hanger
Skewed Right**
(joist must be bevel cut)
All joist nails installed on the
outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _a ³	Header	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb.	(K _D = 1.00) lb.	(K _D = 1.15) lb.	(K _D = 1.00) lb.
Single 2x Sizes											
LUS24	18	1 1/8	3 1/4	1 1/4	2 1/4	(4) 10d	(2) 10d	710	1625	845	1165
								3.16	7.23	2.87	5.14
LU24L	22	1 1/8	3	1 1/4	2 1/8	(4) 10d	(2) 10d x 1 1/2"	360	1020	320	726
								1.60	4.54	1.42	3.22
LU26L	22	1 1/8	5	1 1/4	4 1/4	(6) 10d	(4) 10d x 1 1/2"	720	1606	646	1140
								3.20	7.14	2.87	5.07
SS LUS26	18	1 1/8	4 1/4	1 1/4	3 1/4	(4) 10d	(4) 10d	1420	2170	1290	1630
								6.32	9.65	5.74	7.25
HUS26	18	1 1/8	5 1/4	3	3 3/8	(14) 10d	(8) 16d	2705	4940	2065	3875
								11.30	21.97	9.20	17.24
LJS26DS	18	1 1/8	5	3 1/2	4 1/4	(16) 16d	(8) 16d	2055	4265	1460	4115
								9.14	18.97	6.49	18.31
HGUS26	12	1 1/8	5 1/4	5	4 1/4	(20) 16d	(8) 16d	2685	6625	2685	5700
								11.96	29.51	11.96	25.35
LU28L	20	1 1/8	6 1/4	1 1/4	5 1/4	(8) 10d	(8) 10d x 1 1/2"	1140	2185	1020	1550
								5.07	9.72	4.54	8.89
SS LUS28	18	1 1/8	6 1/4	1 1/4	3 1/4	(6) 10d	(4) 10d	1420	2520	1290	1790
								6.32	11.21	5.74	7.96
HUS28	18	1 1/8	7 1/4	3	6 1/8	(22) 16d	(8) 16d	3605	5385	2675	4345
								16.04	23.88	11.90	19.33
HGUS28	12	1 1/8	7 1/4	5	6 1/4	(36) 16d	(12) 16d	3310	7675	3310	6900
								14.74	34.19	14.74	30.73
LU210L	20	1 1/8	8	1 1/4	7 1/4	(10) 10d	(8) 10d x 1 1/2"	1140	2495	1020	1770
								5.07	11.10	4.54	7.87
SS LUS210	18	1 1/8	7 1/4	1 1/4	3 1/4	(8) 10d	(4) 10d	1420	2785	1290	2210
								6.32	12.39	5.74	9.83

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_a is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSON and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 3/4" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers

SIMPSON
Strong-Tie

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _a ¹	Header	Joist	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN	(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN
Double 2x Sizes											
LUS24-2	18	3 3/8	3 3/8	2	1 1/2	(4) 16d	(2) 16d	835 3.71	2020 8.88	590 2.62	1435 6.38
LUS26-2	18	3 3/8	4 3/8	2	4	(4) 16d	(4) 16d	1720 7.65	2595 11.54	1545 6.87	1920 8.64
HHUS26-2	14	3 3/8	5 3/8	3	3 3/8	(14) 16d	(6) 16d	2850 12.68	7335 32.63	2085 9.20	5205 23.15
HGUS26-2	12	3 3/8	5 3/8	4	4 1/2	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
LUS28-2	18	3 3/8	7	2	4	(8) 16d	(4) 16d	1720 7.65	3325 14.79	1545 6.87	2675 11.45
HHUS28-2	14	3 3/8	7 1/8	3	6 1/4	(22) 16d	(8) 16d	3785 16.75	8940 39.77	2675 11.90	6345 28.22
HGUS28-2	12	3 3/8	7 3/8	4	8 3/8	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
LUS210-2	18	3 3/8	9	2	6	(8) 16d	(8) 16d	2580 11.48	4500 20.02	2320 10.32	3195 14.21
HHUS210-2	14	3 3/8	9 1/8	3	8	(30) 16d	(10) 16d	4670 20.77	9660 42.97	4235 18.84	7000 31.14
HGUS210-2	12	3 3/8	9 3/8	4	8 3/8	(46) 16d	(16) 16d	6840 30.43	14015 62.34	4855 21.60	10270 45.60
Triple 2x Sizes											
HGUS26-3	12	4 1/8	5 1/2	4	4 1/2	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
HGUS28-3	12	4 1/8	7 1/4	4	6 3/8	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d	4670 20.77	9670 43.02	4235 18.84	6865 30.54
HGUS210-3	12	4 1/8	9 1/4	4	8 3/8	(46) 16d	(16) 16d	6840 30.43	14645 65.14	4855 21.60	10400 46.28
Quadruple 2x Sizes											
HGUS26-4	12	6 1/8	5 3/8	4	4 1/2	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
HGUS28-4	12	8 1/8	7 3/8	4	6 1/4	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
HHUS210-4	14	6 1/8	8 3/8	3	7 1/8	(30) 16d	(10) 16d	4670 20.77	10155 45.17	4235 18.84	7210 32.07
HGUS210-4	12	6 1/8	9 3/8	4	8 3/8	(46) 16d	(16) 16d	6840 30.43	14645 65.14	4855 21.60	10400 46.26
HGUS212-4	12	8 1/8	10 3/8	4	10 3/8	(56) 16d	(20) 16d	7640 33.98	14985 66.70	5425 24.13	10845 47.35
HGUS214-4	12	8 1/8	12 3/8	4	11 3/8	(66) 16d	(22) 16d	10130 45.06	16400 72.95	7195 32.00	11645 51.80
4x Sizes											
LUS46	18	3 3/8	4 3/4	2	3 3/8	(4) 16d	(4) 16d	1720 7.65	2595 11.54	1545 6.87	1920 8.54
HHUS46	14	3 3/8	5 1/4	3	3 3/8	(14) 16d	(6) 16d	2540 11.30	7335 32.63	2085 9.20	5205 23.15
HGUS46	12	3 3/8	5 1/4	4	4 1/2	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
LUS48	18	3 3/8	6 3/4	2	3 3/8	(6) 16d	(4) 16d	1720 7.65	3325 14.79	1545 6.87	2575 11.46
HHUS48	14	3 3/8	7 1/8	3	6 1/4	(22) 16d	(8) 16d	3785 16.75	8940 39.77	2675 11.90	6345 28.22
HGUS48	12	3 3/8	7 1/8	4	6 3/8	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
LUS410	18	3 3/8	8 3/4	2	5 3/8	(8) 16d	(8) 16d	2580 11.48	4500 20.02	2320 10.32	3195 14.21
HGUS410	12	3 3/8	9	4	8 3/8	(48) 16d	(18) 16d	6840 30.43	14015 62.34	4855 21.60	10270 45.60
HGUS412	12	3 3/8	10 3/8	4	10 3/8	(56) 16d	(20) 16d	7640 33.98	14985 66.70	5425 24.13	10845 47.35
HGUS414	12	3 3/8	12 3/8	4	11 3/8	(66) 16d	(22) 16d	10130 45.06	16400 72.95	7195 32.00	11645 61.80



Plated Truss Connectors

See footnotes
on p. 258.

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to $1\frac{1}{4}$ ". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x $1\frac{1}{2}$ " = 0.148" dia. x $1\frac{1}{2}$ " long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

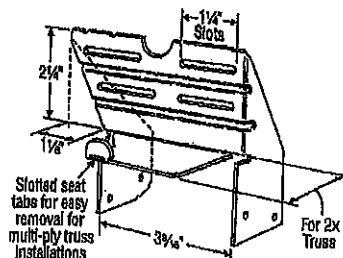


TC24
U.S. Patent 4,932,173

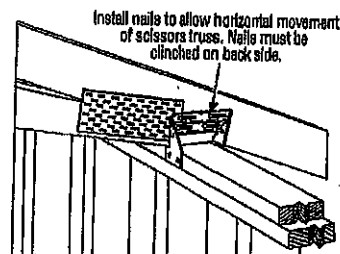


Typical TC24 Installation

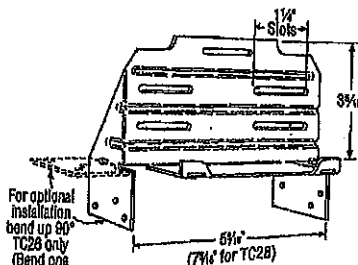

TC26
(TC28 Similar)

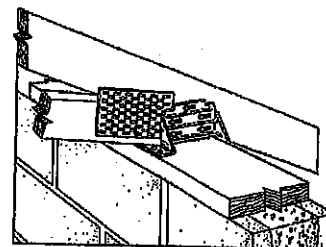

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer (8", 10", 12" Wall Installation Similar)

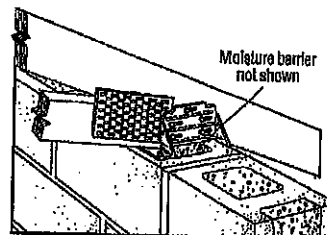


Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift ($K_p=1.15$)	Uplift ($K_p=1.15$)
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(6) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift ($K_p=1.15$)	Uplift ($K_p=1.15$)
TC28	(5) 10d	(6) 10d x $1\frac{1}{2}$ "	810	660
	(5) 10d	(6) 10d	930	660

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.
2. Grout strength is 15 MPa minimum.
3. Optional TC26 installation with 10d nails requires minimum 3" top plate thickness.
4. TC28 fastened to grouted concrete block with (6) - $\frac{9}{16}$ " x $2\frac{1}{4}$ " Titen screws has a factored uplift resistance of 276 lb.

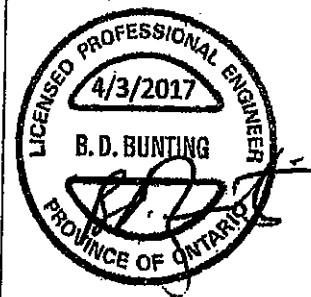

(800) 999-5099
strongtie.com

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_D = 1.15$)					
					D-Fir-L			S-P-F		
		To Rafters/Truss	To Plates	To Studs	Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(6) 8d x 1½"	(4) 8d	—	740	685	300	680	485	215
					3.29	3.05	1.33	3.02	2.16	0.96
SS H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
					3.58	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	180	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	285	615	125	190
					3.29	0.80	1.18	2.74	0.56	0.85
H8	16	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	670	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS H8 ^a	18	(5) 10d x 1½"	(5) 10d x 1½"	—	1120	—	—	1025	—	—
					4.98	—	—	4.56	—	—
SS H10A ^a	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	565	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.54	1.36
H10A-2	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1835	1275	430	1645	880	305
					8.16	5.67	1.91	7.32	3.91	1.36
H10S ^{a,b}	18	(8) 8d x 1½"	(8) 8d x 1½"	(8) 8d	1465	795	315	1040	565	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2½"	(6) 16d x 2½"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	[1] (12) 8d x 1½"	(13) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
		[2] (12) 8d x 1½"	(15) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
TSP	16	(9) 10d x 1½"	(6) 10d x 1½"	—	1295	440	—	920	310	—
					5.76	1.96	—	4.09	1.38	—
		(9) 10d x 1½"	(6) 10d	—	1560	440	—	1105	310	—
					6.94	1.96	—	4.92	1.38	—

- Factored resistances have been increased 15% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 595 lb. (2.65 kN) for D-Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D-Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 6/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D-Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1½" nails into the top plates and (3) 8d x 1½" nails into the lowest three flange holes into the truss bottom chord is 495 lb. (2.20 kN).
- Nails: 16d x 2½" = 0.162" dia. x 2½" long, 10d = 0.148" dia. x 3" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long, 8d x 1½" = 0.131" dia. x 1½" long. See pp. 27-28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry ($< 19\%$ moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

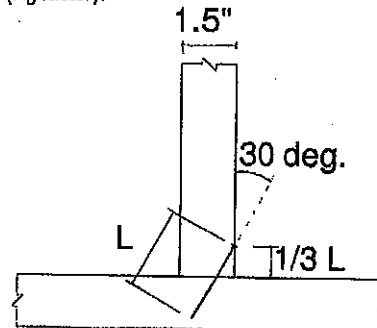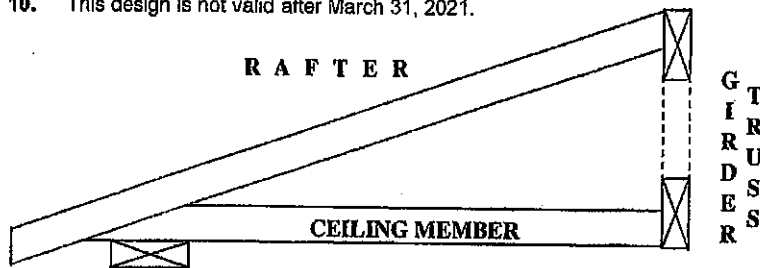

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (In)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019

PEO
Certificate No. 10889486



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to wind or earthquake load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37679H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.


Toe-nailing on 2x6 Bearing Plate

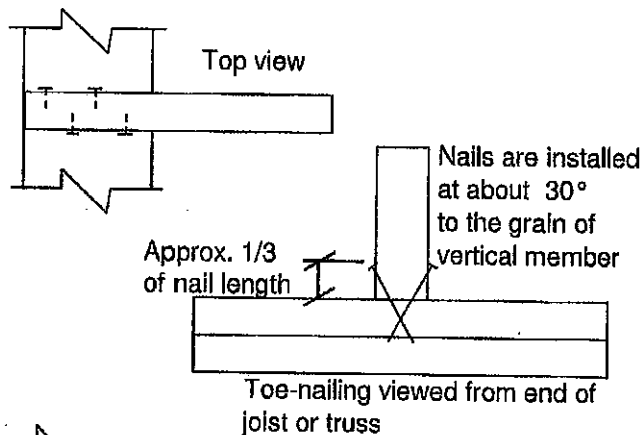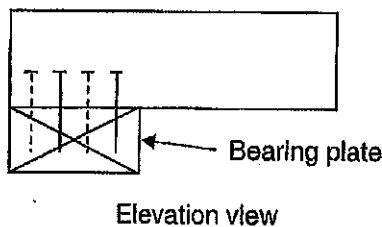

Toe-nailing on 2x4 Bearing Plate

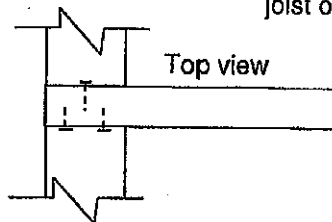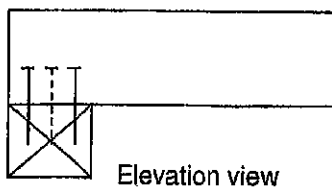


MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7




December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint, unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/4" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 X 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

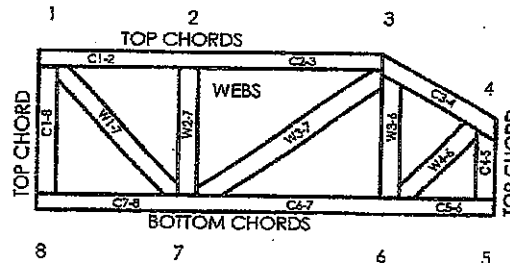

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L 10319-L 13270-L 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MII-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane of joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected ovetop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

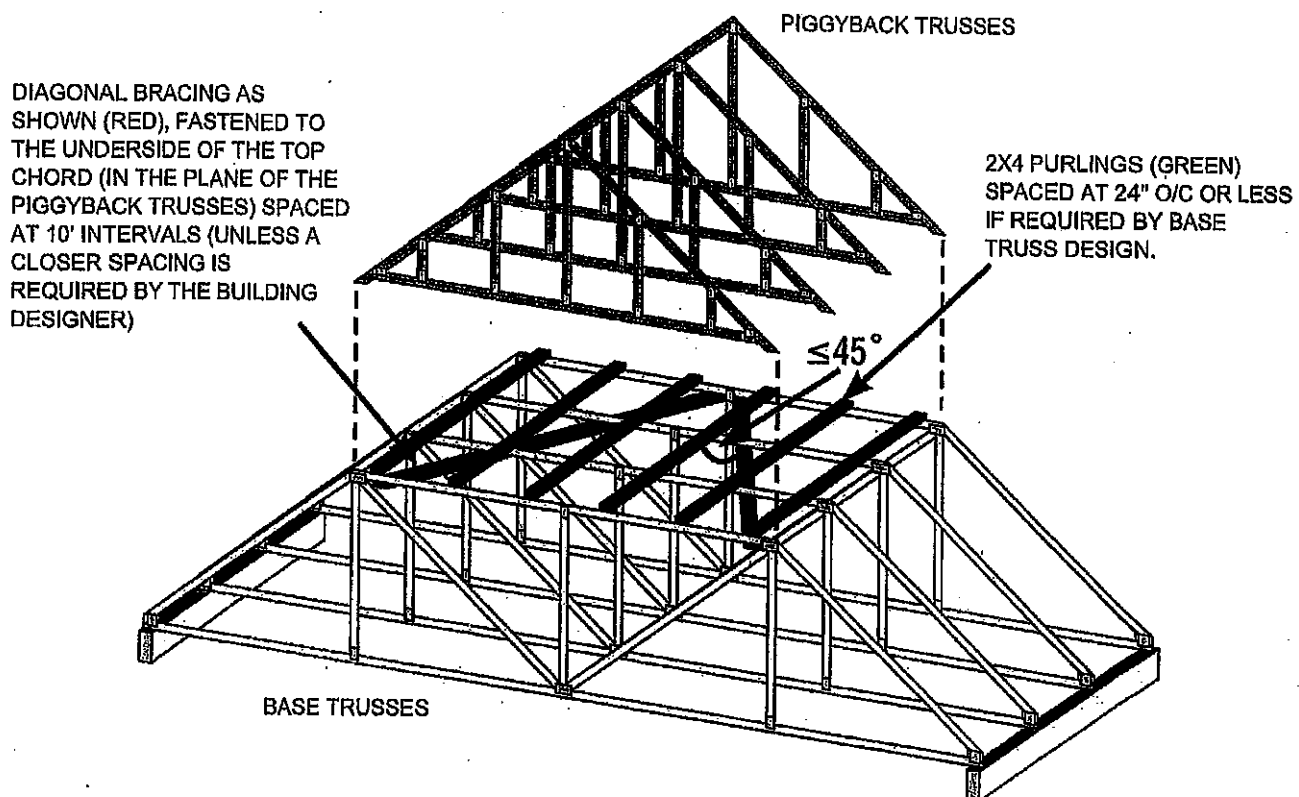


NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufacturer's responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for Information on symbols, numbering system and General Safety notes.

T-1300215

Feb 09, 2018