


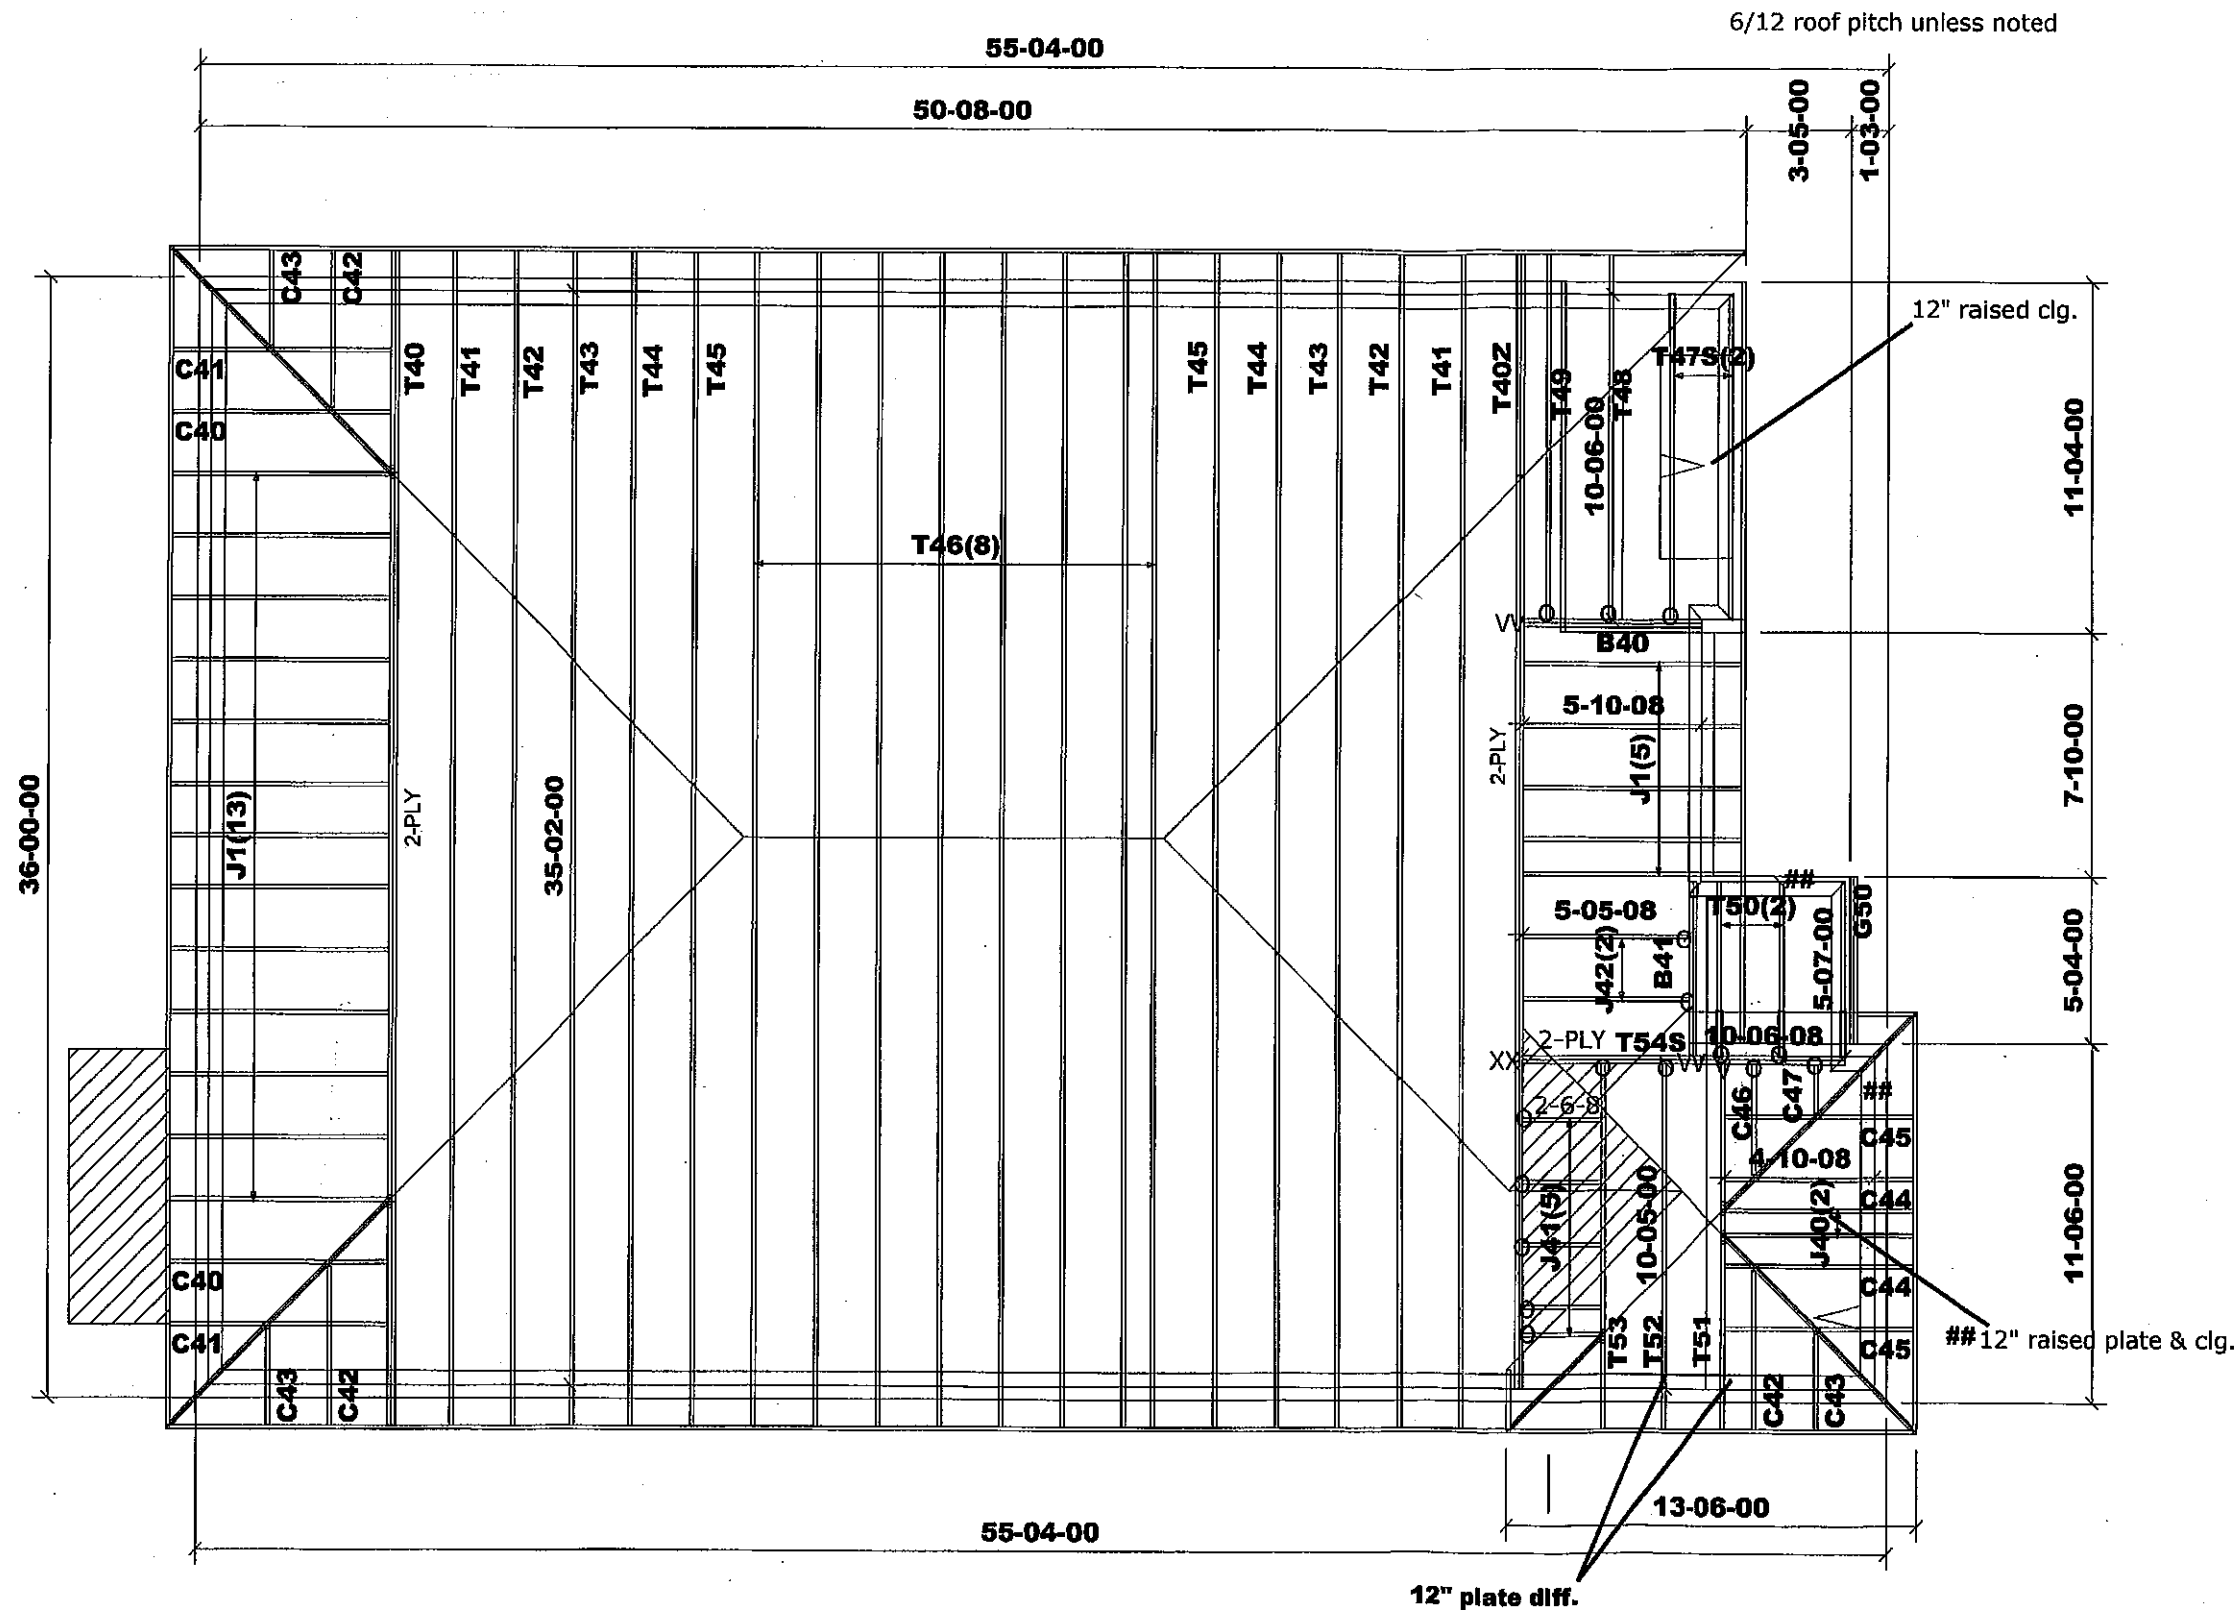

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf
CITY OF HAMILTON Building Division

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)
LUS26-2-(VV)
Permit No. 21-107197
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by

BEAMS:
B40= B41 =
2 - 2x10 SPF #2
FOR CHIEF BUILDING OFFICIAL
DATE 04/09/21

DENOTES: CONVENTIONAL FRAMING

M13138



Job Track: 51225
Plan Log: 202419
Layout ID: 408224

Builder / Location: GREEN PARK HOMES / WATERDOWN
Project: RUSSELL GARDENS PH.3
Date: 2020-04-27 Sales: Mario DiCano Designer: JG

Model / Elevation: MOUNTAINASH 6/3- STD OR OPT.5 BR 207 280
Mtek ver 8.3.1.215

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

DELIVERY SHIPLIST




Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 6
 Lot #: 280
 Elevation: 3- STD OR OPT.5 BR

Job Track: 51225
 PlanLog: 202419
 Layout ID: 408224
 Ref #
 Page: 1 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T40 Hip Girder	6 /12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	337.58 208.00		
	1 2-ply	T40Z Hip Girder	6 /12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	337.58 208.00		
	2	T41 Hip	6 /12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.99 174.00		
	2	T42 Hip	6 /12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.12 174.67		
	2	T43 Hip	6 /12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	289.07 179.87		
	2	T44 Hip	6 /12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	290.73 183.33		
	2	T45 Hip	6 /12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	301.67 191.33		
	8	T46 Common	6 /12	35-02-00	9-11-08	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1178.98 726.33		
	2	T47S Roof Special	0 /12	10-06-00	3-06-00	2 x 4		3-06-00 3-06-00	101.09 83.67		
	1	T48 Half Hip	6 /12	10-06-00	2-08-00	2 x 4	1-03-08	1-02-00 2-08-00	39.94 26.87		
	1	T49 Half Hip	6 /12	10-06-00	3-08-00	2 x 4	1-03-08	1-02-00 3-08-00	41.91 27.50		
	2	T50 Flat	0 /12	5-07-00	3-00-00	2 x 4		3-00-00 3-00-00	45.54 30.00		
	1	G50 GABLE	0 /12	5-07-00	3-00-00	2 x 4		3-00-00 3-00-00	22.18 15.00		
	1	T51 Hip Girder	6 /12	10-05-00	3-07-04	2 x 4	1-03-08	1-02-00 1-03-08	43.52 29.67		

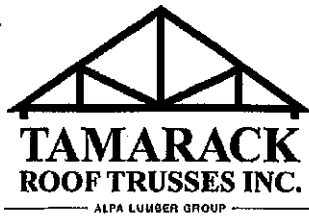

DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 6
 Lot #: 280
 Elevation: 3- STD OR OPT.5 BR

Job Track: 51225
 PlanLog: 202419
 Layout ID: 408224
 Ref #
 Page: 2 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T52 Hip	6 / 12	10-05-00	4-00-00	2 x 4	1-03-08	2-02-00 2-03-08	45.94 29.83		
	1	T53 Hip Girder	6 / 12	10-05-00	3-00-00	2 x 4	1-03-08	2-02-00 2-03-08	46.32 31.83		
	1 2-ply	T54S Roof Special Girder	0 / 12	10-06-08	2-02-00	2 x 4 2 x 6		1-02-00 2-02-00	97.7 64.33		
	18	J1 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	302.3 192.00		
	2	J40 Jack-Open	6 / 12	4-10-08	3-07-04	2 x 4	1-03-08	1-02-00 3-07-04	28.76 18.67		
	5	J41 Jack-Open	6 / 12	2-06-08	3-00-00	2 x 4		1-08-12 3-00-00	49.19 34.17		
	2	J42 Jack-Open	6 / 12	5-05-08	4-01-04	2 x 4		1-04-08 4-01-04	31.44 20.67		
	2	C40 Jack-Open	6 / 12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	28.28 17.33		
	2	C41 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	23.16 14.67		
	3	C42 Jack-Open	6 / 12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	28.71 18.00		
	3	C43 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	21.06 14.00		
	2	C44 Jack-Open	6 / 12	3-09-07	3-00-12	2 x 4	1-03-08 1-01-01	1-02-00 3-00-12	25.98 16.00		
	2	C45 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 3-01-01	1-02-00 2-00-12	20.88 13.33		
	1	C46 Jack-Open	6 / 12	1-07-08	3-00-12	2 x 4	1-10-15	1-03-08 2-01-04	7.46 5.33		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 6
 Lot #: 280
 Elevation: 3- STD OR OPT.5 BR

Job Track: 51225
 PlanLog: 202419
 Layout ID: 408224
 Ref #
 Page: 3 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	C47 Jack-Open	6 / 12	1-07-08	2-00-12	2 x 4		1-03-08 2-01-04	4.91 3.33		

TOTAL # TRUSS= 77

TOTAL BFT OF ALL TRUSSES= 2730.33

BFT.

TOTAL WEIGHT OF ALL TRSSES 4346.93 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	HGUS26-2	
1	Hardware	LJS26DS	
14	Hardware	LUS24	
2	Hardware	LUS26-2	

TOTAL NUMBER OF
ITEMS=

18


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T1	1	2	GREEN PARK HOMES	
TRUSS DESC.					

Faharsack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:00:04 2020 Page 1

ID:DMCubINVR6TstFoe31v6I zns11-Jm9J9tAhZ122g2EEminZsEz3HTHi7mEdCAUuvczMFIf

1-3-8 0-0 1-0-10 1-0-10 5-3-2 9-3-12 5-5-12 1-4-9-8 2-9-8 17-7-0 2-9-8 20-4-8 3-5-12 25-10-4 5-3-2 31-1-6 3-0-10 35-2-0 1-3-8
Scale = 1:57.6

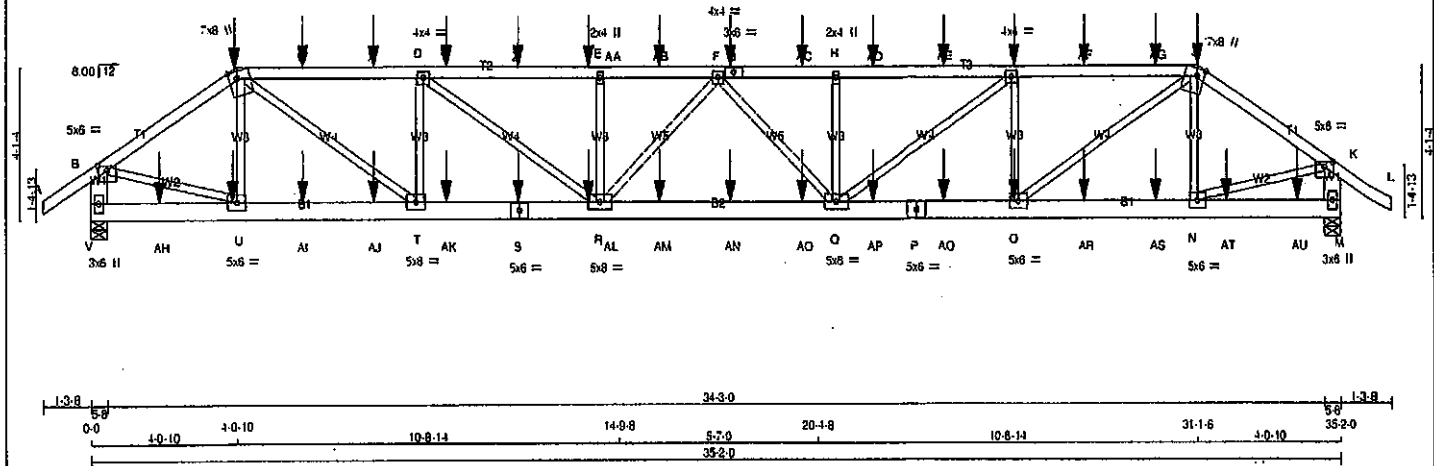

TOTAL WEIGHT = 2 X 161 = 323 lb

LUMBER	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - G	2x4	DRY	No.2
G - J	2x4	DRY	No.2
J - L	2x4	DRY	No.2
V - B	2x6	DRY	No.2
M - K	2x6	DRY	No.2
V - S	2x6	DRY	No.2
S - P	2x6	DRY	No.2
P - M	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	12	SIDE(61.0)
C-G	12	SIDE(61.0)
G-J	12	SIDE(61.0)
J-L	12	SIDE(61.0)
V-B	2	TOP
M-K	2	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
V-S	2	SIDE(183.1)
S-P	2	SIDE(183.1)
P-M	2	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY
GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.
TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG	
JT VERT	3393	0	5-8	5-8
V	3393	0	5-8	5-8
M	3342	0	5-8	5-8

UNFACTORED REACTIONS							
	1ST CASE	MAX-MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
V	2397	1585	0	0	0	812	0
M	2383	1555	0	0	0	808	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.11 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0 35	-91.8 -91.8 0.07 (1)	U-C	-820 0
B-C	-4024 0	-91.8 -91.8 0.22 (1)	C-T	0 3399
C-W	-8074 0	-91.8 -91.8 0.53 (1)	T-D	-1846 0
W-X	-8074 0	-91.8 -91.8 0.53 (1)	D-I	-1869 0
X-O	-8074 0	-91.8 -91.8 0.53 (1)	O-J	0 3425
D-Y	-7423 0	-91.8 -91.8 0.63 (1)	N-J	-801 0
Y-Z	-7423 0	-91.8 -91.8 0.63 (1)	J-U	0 3437
Z-AA	-7423 0	-91.8 -91.8 0.63 (1)	N-K	0 3371
AA-E	-7423 0	-91.8 -91.8 0.63 (1)	E-I	0 1704
E-AB	-7423 0	-91.8 -91.8 0.35 (1)	D-R	0 1677
AB-F	-7423 0	-91.8 -91.8 0.35 (1)	F-H	-595 0
F-G	-7410 0	-91.8 -91.8 0.36 (1)	R-E	-594 0
G-A	-7410 0	-91.8 -91.8 0.36 (1)	E-F	-285 0
AC-H	-7410 0	-91.8 -91.8 0.36 (1)	F-Q	-305 0
H-AD	-7410 0	-91.8 -91.8 0.61 (1)		
AD-AE	-7410 0	-91.8 -91.8 0.61 (1)		
AE-I	-7410 0	-91.8 -91.8 0.61 (1)		
I-AF	-6040 0	-91.8 -91.8 0.51 (1)		
AF-AG	-6040 0	-91.8 -91.8 0.51 (1)		
AG-J	-6040 0	-91.8 -91.8 0.51 (1)		
J-K	-3946 0	-91.8 -91.8 0.22 (1)		
K-L	0 35	-91.8 -91.8 0.07 (1)		
V-B	-3355 0	0.0 0.0 0.12 (1)		
M-K	-3298 0	0.0 0.0 0.12 (1)		

V-AH	0 0	-18.5 -18.5 0.04 (4)	10.00
AH-U	0 0	-18.5 -18.5 0.04 (4)	10.00
U-AI	0 3325	-18.5 -18.5 0.25 (1)	10.00
AI-AJ	0 3325	-18.5 -18.5 0.25 (1)	10.00
AJ-T	0 3325	-18.5 -18.5 0.25 (1)	10.00
T-AK	0 6074	-18.5 -18.5 0.45 (1)	10.00
AK-S	0 6074	-18.5 -18.5 0.45 (1)	10.00
S-AL	0 6074	-18.5 -18.5 0.45 (1)	10.00
AL-R	0 6074	-18.5 -18.5 0.45 (1)	10.00
R-AM	0 7813	-18.5 -18.5 0.57 (1)	10.00
AM-AN	0 7813	-18.5 -18.5 0.57 (1)	10.00
AN-AO	0 7813	-18.5 -18.5 0.57 (1)	10.00
AO-Q	0 7813	-18.5 -18.5 0.57 (1)	10.00
Q-AP	0 6040	-18.5 -18.5 0.45 (1)	10.00
AP-P	0 6040	-18.5 -18.5 0.45 (1)	10.00
P-AQ	0 6040	-18.5 -18.5 0.45 (1)	10.00
AQ-O	0 6040	-18.5 -18.5 0.45 (1)	10.00
O-AR	0 3261	-18.5 -18.5 0.25 (1)	10.00

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TRC 2011, TRC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.23")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/970 (0.44")

CSI: TC=0.63(1.00(D-E)), BC=0.57(1.00(D-R)), WB=0.43(1.00(B-U)), SSI=0.19(1.00(C-D))

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.86 (1) INPUT = 0.90
JSI METAL = 0.58 (1) INPUT = 1.00

CONTINUED ON PAGE 2



Structural component only
DWG# T-2007602 1/2

JOB NAME 408222	TRUSS NAME T1	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Taharack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:04 2020 Page 2	
				ID:DMCubINVR6TsIF0g31v6I zns1I-Jm9J9IAhzI22q2EEmlNZsEz3HTH7?mEdCAUuvczMFI6	

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-p	MT20	5.0	6.0	1.50	3.00
C	TTWW+m	MT20	7.0	8.0	Edge	2.50
D, F, I						
D	TMWW-i	MT20	4.0	4.0		
E	TMWW-w	MT20	2.0	4.0		
G	TS-i	MT20	3.0	6.0		
H	TMWW-w	MT20	2.0	4.0		
J	TTWW+m	MT20	7.0	8.0	Edge	2.50
K	TMWW-p	MT20	5.0	6.0	1.50	3.00
M	BMV1-p	MT20	3.0	6.0		
N, O, T, U						
N	BMWW-1	MT20	5.0	6.0		
P	BS-i	MT20	5.0	6.0		
Q	BMWWW-1	MT20	5.0	6.0		
R	BMWWW-1	MT20	5.0	6.0		
S	BS-i	MT20	5.0	6.0		
V	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED LC1 (LBS)	MAX. UNBRAC. LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED LC1 (LBS)
FR-TO					FR-TO		
AR-AS	0 3261	-18.5	-18.5 0.25 (1)	10.00			
AS-N	0 3261	-18.5	-18.5 0.25 (1)	10.00			
N-AT	0 0	-18.5	-18.5 0.04 (4)	10.00			
AT-AU	0 0	-18.5	-18.5 0.04 (4)	10.00			
AU-M	0 0	-18.5	-18.5 0.04 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-10	-49	-55	---	FRONT	VERT	DEAD	---	C1
C	4-0-10	-117	-117	---	FRONT	VERT	TOTAL	---	C1
C	4-0-10	-254	-254	---	FRONT	VERT	SNOW	---	C1
G	17-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
I	25-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
J	31-1-8	-49	-55	---	FRONT	VERT	DEAD	---	C1
J	31-1-8	-254	-254	---	FRONT	VERT	SNOW	---	C1
O	25-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
S	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
U	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
W	5-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	19-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	21-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	23-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	27-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AG	29-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AH	1-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AL	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AM	15-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AN	17-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AO	19-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AP	21-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AQ	23-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AR	27-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AS	29-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AT	31-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AU	33-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007602 7/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T1Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:05 2020 Page 1
 ID:DMCubINVR6TslFoe31v6l zns11-nyjhmNBKcAvHCpQKTuoORWDoscNkApnRqDRR2zMFile
 35-2-0 35-3-8
 Scale = 1:57.6

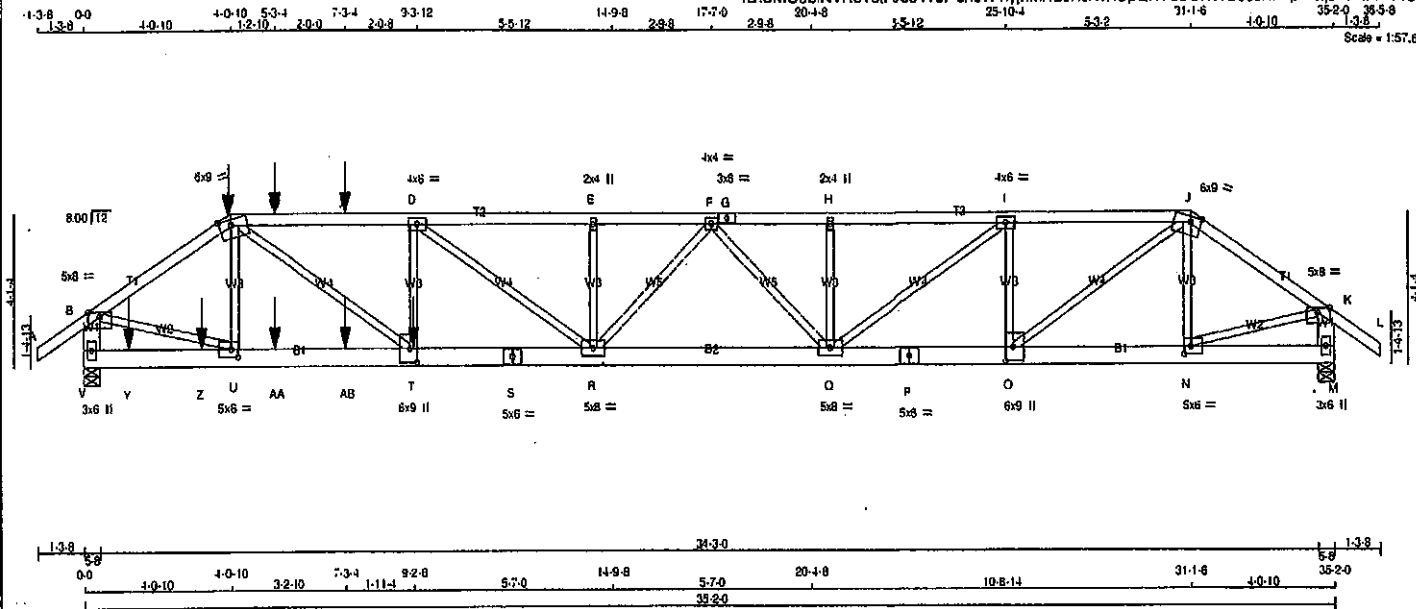

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - G	2x4	DRY	No.2
G - J	2x4	DRY	No.2
J - L	2x4	DRY	No.2
V - B	2x6	DRY	No.2
M - K	2x6	DRY	No.2
V - S	2x6	DRY	No.2
S - P	2x6	DRY	No.2
P - M	2x6	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	12	SIDE(61.0)
C-G	12	SIDE(61.0)
G-J	12	TOP
J-L	12	TOP
V-B	12	TOP
M-K	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
V-S	12	SIDE(183.1)
S-P	12	TOP
P-M	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	SIDE(385.4)
D-T	4	
I-O	4	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	IN-SX	IN-SX
V	4215	0	5-8	5-8
M	2722	0	5-8	5-8

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE
V	2974	1987	0	0
M	1921	1263	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.00 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1
FR-TO		FROM	TO			FR-TO		FROM	TO
A-B	0 35	-91.8	-91.8	0.07 (1)	10.00	U-C	-783 0	-91.8	0.10 (1)
B-C	-5115 0	-91.8	-91.8	0.28 (1)	4.07	C-T	0 481	-91.8	0.60 (1)
C-W	-8135 0	-91.8	-91.8	0.64 (1)	3.00	T-D	-622 0	-91.8	0.08 (1)
W-X	-8135 0	-91.8	-91.8	0.64 (1)	3.00	O-I	-1797 0	-91.8	0.23 (1)
X-D	-8135 0	-91.8	-91.8	0.64 (1)	3.00	O-J	0 321	-91.8	0.40 (1)
D-E	-8106 0	-91.8	-91.8	0.59 (1)	3.05	N-J	-512 0	-91.8	0.06 (1)
E-F	-8106 0	-91.8	-91.8	0.32 (1)	3.28	B-U	0 437	-91.8	0.54 (1)
F-G	-6926 0	-91.8	-91.8	0.28 (1)	3.57	N-K	0 289	-91.8	0.33 (1)
G-H	-6926 0	-91.8	-91.8	0.28 (1)	3.57	O-I	0 213	-91.8	0.28 (1)
H-I	-6926 0	-91.8	-91.8	0.45 (1)	3.42	D-R	-37 24	-91.8	0.01 (1)
I-J	-5210 0	-91.8	-91.8	0.34 (1)	3.89	O-H	-385 0	-91.8	0.05 (1)
J-K	-3153 0	-91.8	-91.8	0.19 (1)	5.04	R-E	-343 0	-91.8	0.04 (1)
K-L	0 35	-91.8	-91.8	0.07 (1)	10.00	R-F	0 892	-91.8	0.09 (1)
V-B	-4180 0	0.0	0.0	0.15 (1)	8.89	F-Q	-1081 0	0.0	0.23 (1)
M-K	-2896 0	0.0	0.0	0.10 (1)	7.81				
V-Y	0 0	-18.5	-18.5	0.05 (4)	10.00				
Y-Z	0 0	-18.5	-18.5	0.05 (4)	10.00				
Z-U	0 0	-18.5	-18.5	0.05 (4)	10.00				
U-AA	0 4227	-18.5	-18.5	0.35 (1)	10.00				
AA-AB	0 4227	-18.5	-18.5	0.35 (1)	10.00				
AB-T	0 4227	-18.5	-18.5	0.35 (1)	10.00				
T-S	0 8135	-18.5	-18.5	0.81 (1)	10.00				
S-R	0 8135	-18.5	-18.5	0.81 (1)	10.00				
R-Q	0 7645	-18.5	-18.5	0.66 (1)	10.00				
Q-P	0 5210	-18.5	-18.5	0.38 (1)	10.00				
P-O	0 5210	-18.5	-18.5	0.38 (1)	10.00				
O-N	0 2604	-18.5	-18.5	0.19 (1)	10.00				
N-M	0 0	-18.5	-18.5	0.03 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
JT	4-0-10	-49	55	---	FRONT	DEAD	---	C1
C	4-0-10	-254	-254	---	FRONT	SNOW	---	C1
T	9-2-8	-2179	-2179	---	BACK	TOTAL	---	C1
W	5-3-4	-110	-110	---	BACK	TOTAL	---	C1
X	7-3-4	-110	-110	---	BACK	TOTAL	---	C1
Y	1-3-4	-28	-28	---	BACK	TOTAL	---	C1
Z	3-3-4	-28	-28	---	BACK	TOTAL	---	C1
AA	5-3-4	-28	-28	---	BACK	TOTAL	---	C1
AB	7-3-4	-28	-28	---	BACK	TOTAL	---	C1

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
 GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
 LOADS WERE DERIVED FROM USER INPUT
 NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL	LD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD
 EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.24")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/954 (0.44")

OSI: TC=0.84/1.00 (C-D:1), BC=0.81/1.00 (R-T:1),
 WB=0.60/1.00 (C-T:1), SS=0.17/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	616	354 1667 788 1957 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (J) INPUT = 0.90
 JSI METAL = 0.77 (P) INPUT = 1.00



Structural component only
 DWG# T-2007603 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T1Z	1	2	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:05 2020 Page 2

ID:DMCubINVR6TstFoe31v6I zns1I-nvhhMNBjKcAvHCpQKTuoQRWDoScNkAonRqDRR2zMFle


PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TTWW-m	MT20	8.0	9.0	1.75	3.50
D	TMWW-l	MT20	4.0	6.0		
E	TMW-w	MT20	2.0	4.0		
F	TMWW-l	MT20	4.0	4.0		
G	TS-l	MT20	3.0	6.0		
H	TMW-w	MT20	2.0	4.0		
I	TMWW-l	MT20	4.0	6.0		
J	TTWW-m	MT20	8.0	9.0	1.75	3.50
K	TMVW-p	MT20	5.0	8.0	Edge	
M	BMV-l-p	MT20	3.0	8.0		
N	BMWW-l	MT20	5.0	8.0	2.50	2.25
O	BMWW-l	MT20	6.0	9.0	4.50	2.50
P	BS-l	MT20	5.0	8.0		
Q	BMWW-l	MT20	5.0	8.0		
R	BMWW-l	MT20	5.0	8.0		
S	BS-l	MT20	5.0	6.0		
T	BMWW-l	MT20	8.0	9.0	4.50	2.50
U	BMWW-l	MT20	5.0	6.0	2.50	2.25
V	BMV-l-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

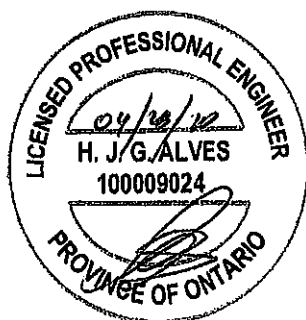

Structural component only
DWG# T-2007603 42

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
4Q8222	T2	2	1	TRUSS DESC.		


Tamarack Roof Truss, Burlington

Version 8.310 S Oct 28 2019 Mitek Industries, Inc. Tue Apr 28 09:00:06 2020 Page 1

ID:DMCubINVR6TsIFoe31v6I zns1I-F8H4a[Cx5wlmvMOcuAP1x2LCGy5TgYwIUz? UzMFId

35-2-0 35-5-8 1-3-8

Scale = 1:57.6

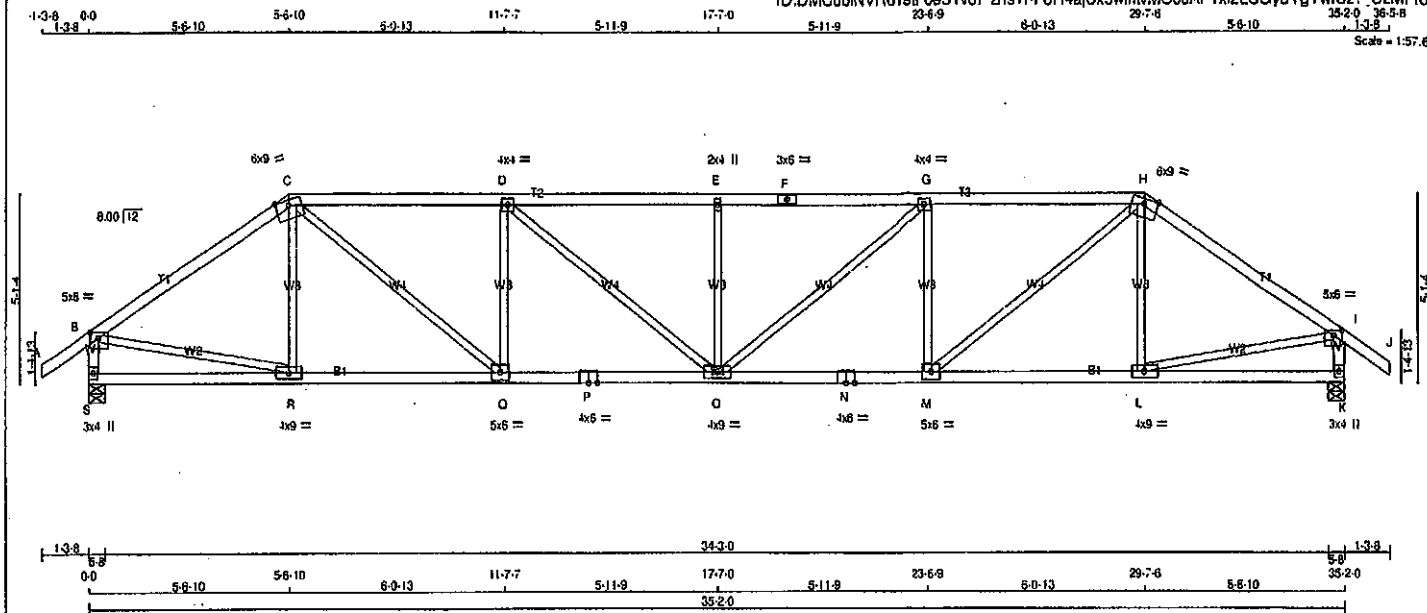

TOTAL WEIGHT = 2 X 140 = 280 lb

CHORDS	SIZE	LUMBER	DESCR
A - C	2x4	DRY No.2	SPF
C - F	2x4	DRY No.2	SPF
F - H	2x4	DRY No.2	SPF
H - J	2x4	DRY No.2	SPF
S - B	2x4	DRY No.2	SPF
K - I	2x4	DRY No.2	SPF
S - P	2x4	DRY No.2	SPF
P - N	2x4	DRY No.2	SPF
N - K	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	2.75
C	TTWW-m	MT20	5.0	9.0	Edge	
D	TMVW-i	MT20	4.0	4.0		
E	TMVW-w	MT20	2.0	4.0		
F	TS-i	MT20	3.0	6.0		
G	TMVW-i	MT20	4.0	4.0		
H	TTWW-m	MT20	6.0	9.0	Edge	
I	TMVW-g	MT20	5.0	6.0	1.75	2.75
K	BMVW-i-p	MT20	3.0	4.0		
L	BMVW-i	MT20	4.0	9.0		
M	BMVW-i	MT20	5.0	6.0		
N	BS-i	MT20	4.0	6.0		
O	BMVW-W-i	MT20	4.0	9.0		
P	BS-i	MT20	4.0	6.0		
Q	BMVW-i	MT20	5.0	6.0		
R	BMVW-i	MT20	4.0	9.0		
S	BMVW-i-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
S	2065	0	2065	0
K	2065	0	2065	0

UNFACTORED REACTIONS

JT	1ST LOASE COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1458	970.0	0.0	0.0	0.0	485.0	0.0
K	1458	970.0	0.0	0.0	0.0	485.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.97 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)
FR-TO		FROM TO		FR-TO		FROM TO	
A-B	0 35	-91.8 -91.8	0.12 (1)	10.00	R-C	-243 10	0.09 (1)
B-C	-2286 0	-91.8 -91.8	0.70 (1)	3.78	C-Q	0 1670	0.38 (1)
C-D	-3213 0	-91.8 -91.8	0.80 (1)	3.19	Q-D	-929 0	0.36 (1)
D-E	-3594 0	-91.8 -91.8	0.86 (1)	2.97	D-Q	0 490	0.11 (1)
E-F	-3594 0	-91.8 -91.8	0.86 (1)	2.97	Q-E	-505 0	0.19 (1)
F-G	-3594 0	-91.8 -91.8	0.86 (1)	2.97	Q-G	0 490	0.11 (1)
G-H	-3213 0	-91.8 -91.8	0.80 (1)	3.19	M-G	-829 0	0.36 (1)
H-I	-2286 0	-91.8 -91.8	0.70 (1)	3.78	M-H	0 1670	0.38 (1)
I-J	0 35	-91.8 -91.8	0.12 (1)	10.00	L-H	-243 10	0.09 (1)
S-B	-2023 0	0.0 0.0	0.21 (1)	5.94	B-R	0 -1943	0.44 (1)
K-I	-2023 0	0.0 0.0	0.21 (1)	5.94	L-I	0 1943	0.44 (1)
S-R	0 0	-18.5 -18.5	0.15 (4)	10.00			
R-O	0 1903	-18.5 -18.5	0.39 (1)	10.00			
O-P	0 3213	-18.5 -18.5	0.58 (1)	10.00			
P-O	0 3213	-18.5 -18.5	0.58 (1)	10.00			
O-N	0 3213	-18.5 -18.5	0.58 (1)	10.00			
N-M	0 3213	-18.5 -18.5	0.58 (1)	10.00			
M-L	0 1903	-18.5 -18.5	0.39 (1)	10.00			
L-K	0 0	-18.5 -18.5	0.15 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CSI: TC=0.86/1.00 (D-E:1), BC=0.58/1.00 (M-O:1), WB=0.44/1.00 (I-L:1), SS=0.28/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN
MT20	818	354	1667	788	1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (I) INPUT = 0.90 I
JSI METAL = 0.74 (I) INPUT = 1.00 I



Structural component only
DWG# T-2007604


JOB NAME 408222	TRUSS NAME T3	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	-------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:00:06 2020 Page 1

ID:DMCubINVR6TstFoe31v6L_zns11-F8H4ajCx5wlmvMOCuAP1xf2QrG_VTXHwIUz?_UzMFid

1-3.8 0-0 3-7.9 3-5.1 7-0-10 5-3-13 12-4-7 5-2-9 17-7-0 5-2-9 22-9-9 5-3-13 28-1-6 7-5-1 31-0-7 35-2-0 35-5-8 1-3-8
Scale = 1:57.6

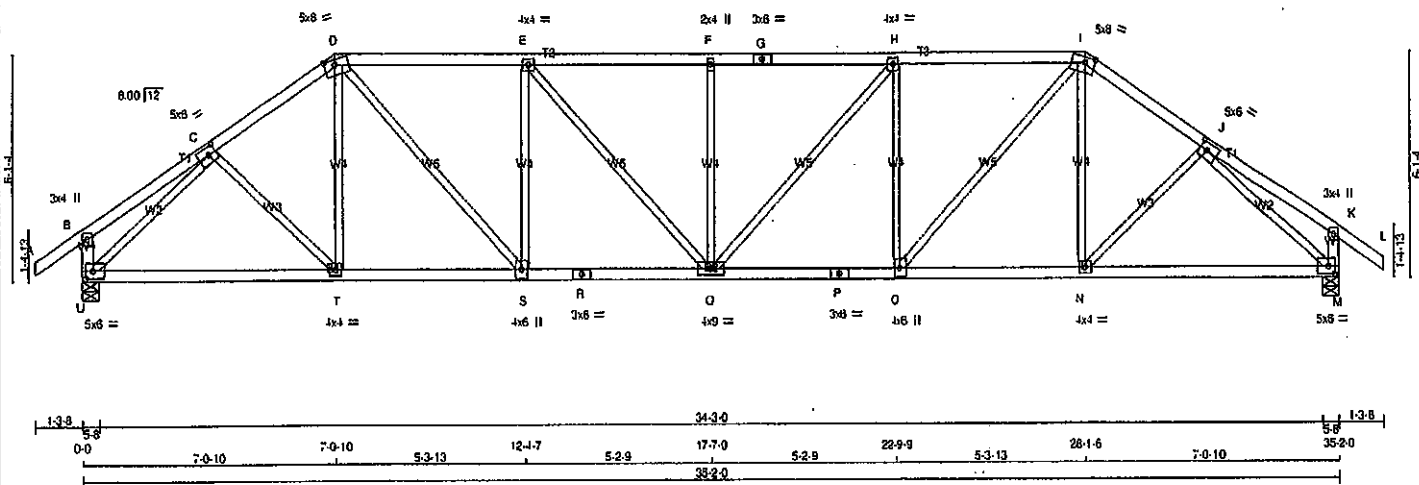

TOTAL WEIGHT = 2 X 151 = 303 lb (M)

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
U - B	2x4	DRY	No.2
M - K	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - P	2x4	DRY	No.2
P - M	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMW+p	MT20	3.0	4.0
C	TMWW-I	MT20	5.0	6.0 2.50 2.50
D	TTWW-m	MT20	5.0	8.0 1.75 3.50
E	TMWW-I	MT20	4.0	4.0
F	TMWW-w	MT20	2.0	4.0
G	TS-I	MT20	3.0	6.0
H	TMWW-I	MT20	4.0	4.0
I	TTWW-m	MT20	5.0	8.0 1.75 3.50
J	TMWW-I	MT20	5.0	6.0 2.50 2.50
K	TMW+p	MT20	3.0	4.0
M	BMWW-I	MT20	5.0	6.0 2.50 2.25
N	BMWW-I	MT20	4.0	4.0
O	BMWW-I	MT20	4.0	6.0
P	BS-I	MT20	3.0	6.0
Q	BMWWW-I	MT20	4.0	9.0
R	BS-I	MT20	3.0	6.0
S	BMWW-I	MT20	4.0	6.0
T	BMWW-I	MT20	4.0	4.0
U	BMWW-I	MT20	5.0	6.0 2.50 2.25

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	DOWN	BRG	BRG
U	2065	0	2065	0	5-8
M	2065	0	2065	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
U	1458	970	0	0	0	0	489	0
M	1458	970	0	0	0	0	489	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.53 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF) FROM TO	MAX. UNBRACED LENGTH FR-TO
A-B	0 35	-91.8 -91.8 0.12 (1)	10.00
B-C	0 18	-91.8 -91.8 0.16 (1)	10.00
C-D	-2305 0	-91.8 -91.8 0.23 (1)	4.31
D-E	-2723 0	-91.8 -91.8 0.34 (1)	3.69
E-F	-2986 0	-91.8 -91.8 0.56 (1)	3.53
F-G	-2986 0	-91.8 -91.8 0.56 (1)	3.53
G-H	-2986 0	-91.8 -91.8 0.56 (1)	3.53
H-I	-2723 0	-91.8 -91.8 0.54 (1)	3.69
I-J	-2305 0	-91.8 -91.8 0.23 (1)	4.31
J-K	0 18	-91.8 -91.8 0.16 (1)	10.00
K-L	0 35	-91.8 -91.8 0.12 (1)	10.00
U-B	-255 0	0.0 0.0 0.03 (1)	7.81
M-K	-255 0	0.0 0.0 0.03 (1)	7.81

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF) FROM TO	MAX. UNBRACED LENGTH FR-TO
U-T	0 1801	-18.5 -18.5 0.40 (1)	10.00
T-S	0 1900	-18.5 -18.5 0.41 (1)	10.00
S-R	0 2723	-18.5 -18.5 0.49 (1)	10.00
R-Q	0 2723	-18.5 -18.5 0.49 (1)	10.00
Q-P	0 2723	-18.5 -18.5 0.49 (1)	10.00
P-O	0 2723	-18.5 -18.5 0.49 (1)	10.00
O-N	0 1900	-18.5 -18.5 0.41 (1)	10.00
N-M	0 1801	-18.5 -18.5 0.40 (1)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/989 (0.16")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/989 (0.29")

CSI: TC=0.58/1.00 (E-F:1), BC=0.49/1.00 (O-C:1), WB=0.97/1.00 (J-M:1), SS=0.23/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618 354 1667 786 1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.90 (M) INPUT = 0.90
JSI METAL=0.84 (P) INPUT = 1.00



Structural component only
DWG# T-2007605

JOB NAME 408222	TRUSS NAME T4	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:00:07 2020 Page 1	ID:DMCubIIVR6TsiFoa31v6I_zns1H-jLrSn2CZsDQdXWzpsuWGTsbZlgK2C5T4u8iVWwzMFic
1-3.8 0-0 4-4.9 4-4.9 4-2.1 8-6-10 6-0-11 14-7-5 5-11-7 20-8-11 6-0-11 26-7-6 4-2-1 30-9-7 4-4-9 35-2-0 1-3.8 Scale = 1:57.6					

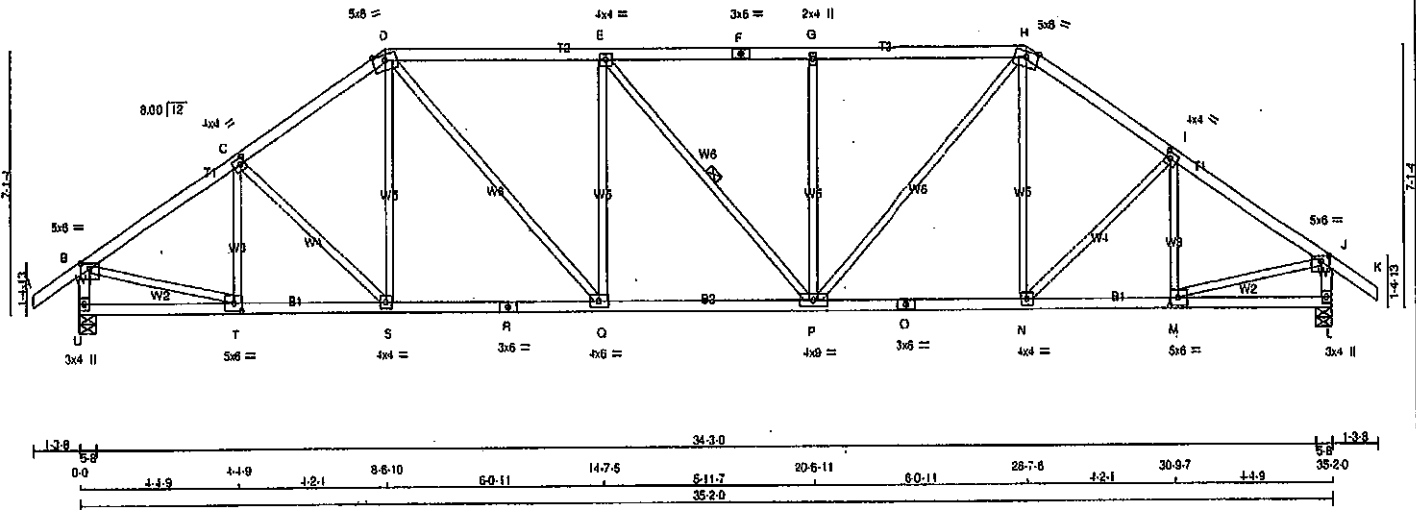

TOTAL WEIGHT = 2 X 155 = 309 lb (M)

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
U - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table in inches)			
JT TYPE	PLATES	W	LEN Y X
B TMW-p	MT20	5.0	6.0 1.75 2.75
C TMW-f	MT20	4.0	4.0 2.00 1.50
D TTW-w	MT20	5.0	8.0 Edge
E TMW-f	MT20	4.0	4.0
F TS-1	MT20	3.0	6.0
G TMW-w	MT20	2.0	4.0
H TTW-w	MT20	5.0	8.0 Edge
I TMW-f	MT20	4.0	4.0 2.00 1.50
J TMW-p	MT20	5.0	8.0 1.75 2.75
L BMV1-p	MT20	3.0	4.0
M BMWW-1	MT20	5.0	8.0 2.50 2.75
N BMWW-1	MT20	4.0	4.0
O BS-1	MT20	3.0	6.0
P BMWW-1	MT20	4.0	9.0
Q BMWW-1	MT20	4.0	8.0
R BS-1	MT20	3.0	6.0
S BMWW-1	MT20	4.0	4.0
T BMWW-1	MT20	5.0	8.0 2.50 2.75
U BMV1-p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT GROSS REACTION	RECORD GROSS REACTION
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
U	2065	0	2065	0	5-8
L	2065	0	2065	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	SNOW	LIVE	PERALIVE	WIND	DEAD	SOIL
U	1458	970	0	0	0	488	0
L	1458	970	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-F.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0 35	T-C	-397 0
B-C	-2269 0	C-S	-78 0
C-D	-2254 0	S-D	0 155
D-E	-2485 0	D-Q	0 949
E-F	-2483 0	Q-E	-597 0
F-G	-2483 0	E-P	-2 0
G-H	-2483 0	P-G	-597 0
H-I	-2254 0	I-H	0 947
I-J	-2269 0	N-H	0 157
J-K	0 35	N-I	-78 0
K-B	-2027 0	M-I	-397 0
L-J	-2026 0	B-T	0 1965
		M-J	0 1965
U-T	0 0		
T-S	0 1908		
S-R	0 1853		
R-Q	0 1853		
Q-P	0 2485		
P-O	0 1854		
O-N	0 1854		
N-M	0 1908		
M-L	0 0		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSF: TC=0.84/1.00 (D-E:1), BC=0.47/1.00 (P-Q:1), WB=0.52/1.00 (E-Q:1), SS=0.26/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (D) (INPUT = 0.90)
JSI METAL = 0.62 (O) (INPUT = 1.00)




Structural component only
DWG# T-2007606

JOB NAME 408222	TRUSS NAME T5	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:00:08 2020 Page 1

ID:DMCubINVR6TsFoe31v6I zns11-BXPq ODBdXYU8IY??bRV048IM4gExZrD7G52NzMFIt

1-3.8 0-0 5-1.9 5-1.9 4-11.1 10-0-10 7-6.6 17-7-0 7-6.6 25-1-6 4-11.1 30-0-7 5-1.9 35-2-0 1-3.8
Scale = 1:57.6

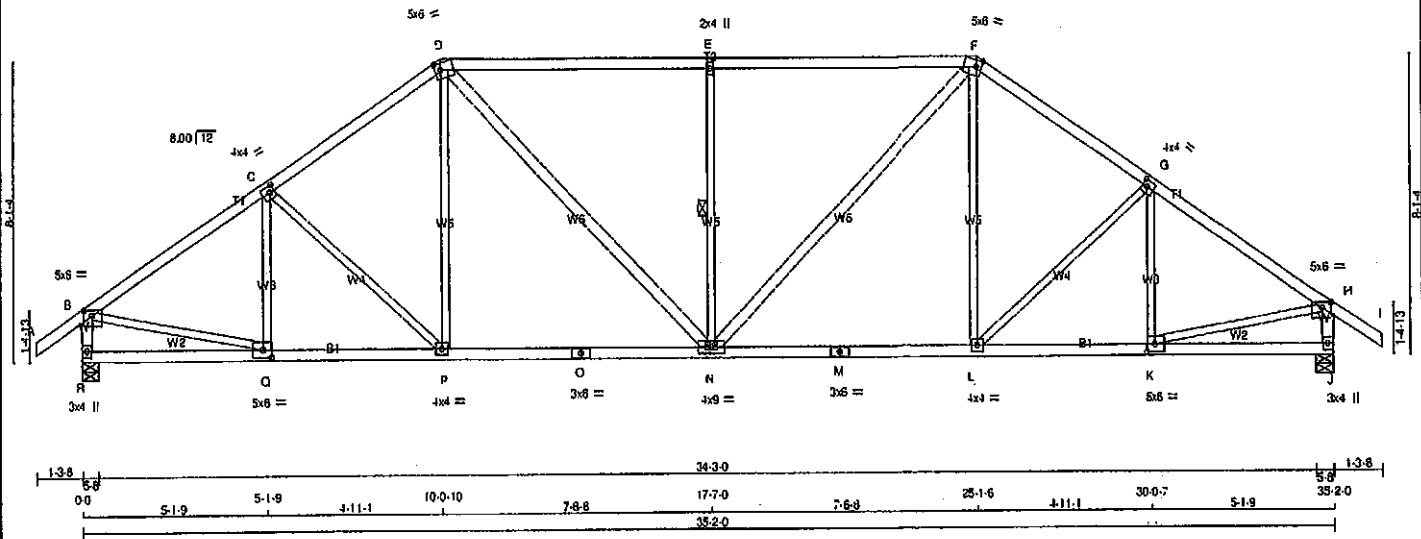

TOTAL WEIGHT = 2 X 158 = 317 lb [M/F]

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - I	2x4	DRY	No.2	SPF	
R - B	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
R - O	2x4	DRY	No.2	SPF	
O - M	2x4	DRY	No.2	SPF	
M - J	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
D - N	2x4	DRY	No.2	SPF	
N - F	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	6.0	1.75	2.75
C	TMWW-I	MT20	4.0	4.0	2.00	1.50
D	TTWW-m	MT20	5.0	6.0	2.25	1.75
E	TMW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	6.0	2.25	1.75
G	TMWW-I	MT20	4.0	4.0	2.00	1.50
H	TMWV-p	MT20	5.0	6.0	1.75	2.75
J	BMV-I+p	MT20	3.0	4.0		
K	BMWW-I	MT20	5.0	6.0	2.50	2.75
L	BMWW-I	MT20	4.0	4.0		
M	BS-I	MT20	3.0	6.0		
N	BMWW-I	MT20	4.0	9.0		
O	BS-I	MT20	3.0	6.0		
P	BMWW-I	MT20	4.0	4.0		
Q	BMWW-I	MT20	5.0	6.0	2.50	2.75
R	BMV-I+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
R	2085	0	2085	0
J	2085	0	2085	0

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1458	970	0	0	0	489	0
J	1458	970	0	0	0	489	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	CS (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 35	-91.8	-91.8 0.12 (1)	10.00	Q-C	-321	0 0.11 (1)
B-C	-2317	0	-91.8 -91.8 0.38 (1)	4.16	P-D	-218	0 0.18 (1)
C-D	-2185	0	-91.8 -91.8 0.37 (1)	4.28	P-O	0 266	0.06 (1)
D-E	-2274	0	-91.8 -91.8 0.81 (1)	3.47	D-N	0 691	0.11 (1)
E-F	-2274	0	-91.8 -91.8 0.81 (1)	3.47	N-E	-851	0 0.35 (1)
F-G	-2185	0	-91.8 -91.8 0.37 (1)	4.28	N-F	0 691	0.11 (1)
G-H	-2317	0	-91.8 -91.8 0.38 (1)	4.16	L-F	0 266	0.08 (1)
H-I	0 35	-91.8	-91.8 0.12 (1)	10.00	L-G	-218	0 0.18 (1)
R-B	-2022	0	0.0 0.0 0.21 (1)	5.94	K-G	-321	0 0.11 (1)
J-H	-2022	0	0.0 0.0 0.21 (1)	5.94	B-Q	0 1995	0.45 (1)
R-Q	0 0	-18.5	-18.5 0.10 (4)	10.00	K-H	0 1995	0.45 (1)
Q-P	0 1953	-18.5	-18.5 0.40 (1)	10.00			
P-O	0 1794	-18.5	-18.5 0.41 (1)	10.00			
O-N	0 1794	-18.5	-18.5 0.41 (1)	10.00			
N-M	0 1794	-18.5	-18.5 0.41 (1)	10.00			
M-L	0 1794	-18.5	-18.5 0.41 (1)	10.00			
L-K	0 1953	-18.5	-18.5 0.40 (1)	10.00			
K-J	0 0	-18.5	-18.5 0.10 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CS: TC=0.81.1.00 (E-F:1), BC=0.41.1.00 (L-N:1).
WB=0.45.1.00 (H-K:1). SS=0.34.1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LBS DEW=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (H) (INPUT = 0.99)
JSI METAL = 0.64 (M) (INPUT = 1.00)




Structural component only
DWG# T-2007607

JOB NAME 4Q8222	TRUSS NAME T6	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 3.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:00:09 2020 Page 1
ID:DMCubINVR6TstF0e31v6t_zns11-fjyCCkEpOrgLmp6BZlykZHqkU0ng01MLSBapzMFia

Scale = 1:57.6

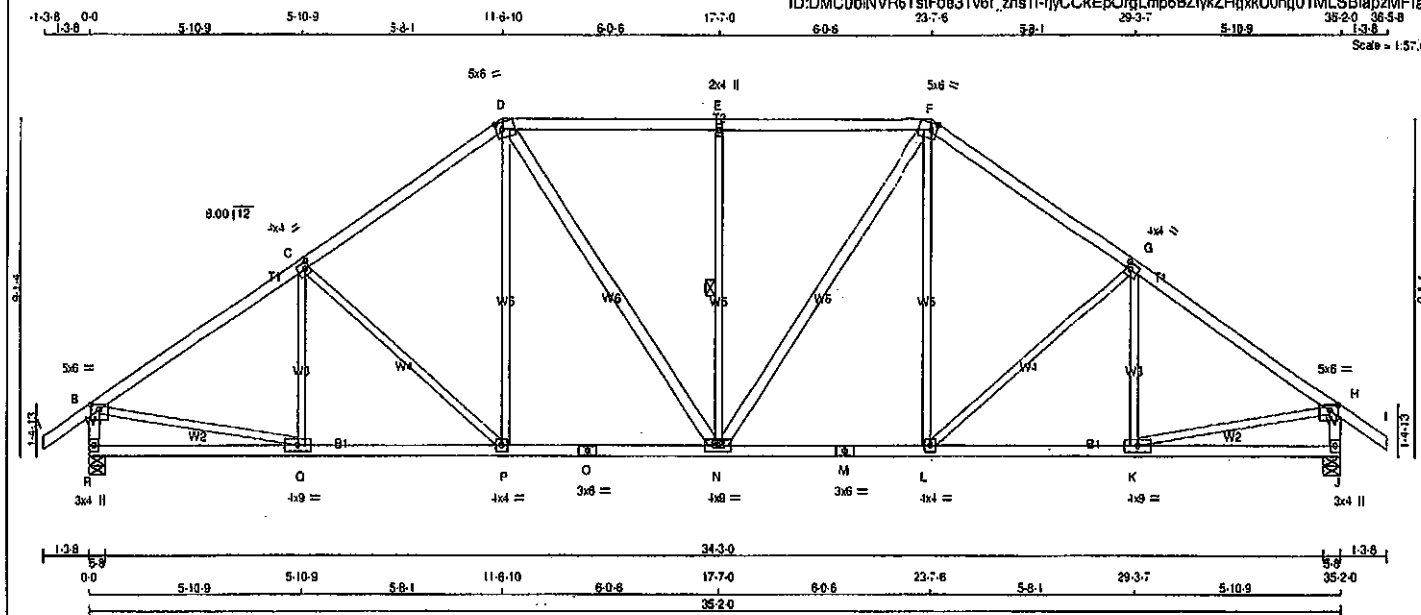

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
EXCEPT			
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)				
JT	TYPE	PLATES	W.	LEN Y X
B	TMWV-p	MT20	5.0	6.0 1.75 2.75
C	TMWV-l	MT20	4.0	4.0 2.00 1.50
D	TTWV-m	MT20	5.0	6.0 2.25 2.00
E	TMWV-w	MT20	2.0	4.0
F	TTWV-m	MT20	5.0	6.0 2.25 2.00
G	TMWV-l	MT20	4.0	4.0 2.00 1.50
H	TMWV-p	MT20	5.0	6.0 1.75 2.75
J	BMV-l-p	MT20	3.0	4.0
K	BMWV-l	MT20	4.0	9.0
L	BMWV-l	MT20	4.0	4.0
M	BS-l	MT20	3.0	6.0
N	BMWV-l	MT20	4.0	9.0
O	BS-l	MT20	3.0	6.0
P	BMWV-l	MT20	4.0	4.0
Q	BMWV-l	MT20	4.0	9.0
R	BMV-l-p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
R	2065	0	2065	0	5-8
J	2065	0	2065	0	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
R	1458	970	0	0	0	488	0
J	1458	970	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO	FROM TO	FR-TO	FROM TO
A-B	0 35	Q-C	-249 11
B-C	-2346 0	C-P	-356 0
C-D	-2085 0	P-D	0 341
D-E	-1985 0	D-N	0 477
E-F	-1985 0	N-E	-678 0
F-G	-2095 0	N-F	0 477
G-H	-2346 0	L-F	0 341
H-I	0 35	L-G	-356 0
R-B	-2018 0	K-G	-249 11
J-H	-2018 0	B-Q	0 2014
R-Q	0 0	K-H	0 2014
Q-P	0 1980		
P-O	0 1716		
O-N	0 1716		
N-M	0 1716		
M-L	0 1716		
L-K	0 1981		
K-J	0 0		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIG 2011, TPIG 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.10')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.19')

CS: TO=0.52/1.00 (G-H:1), SC=0.39/1.00 (K-L:1), WB=0.45/1.00 (H-K:1), SS=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 L3 BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1887 786	1087 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (H) INPUT = 0.90
JSI METAL= 0.56 (M) INPUT = 1.00



Structural component only
DWG# T-2007608

JOB NAME 408222	TRUSS NAME T7	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:10 2020 Page 1					
ID:DMCubINVR6TslFoe31v6l_zns11-7wWap4FR98oCO2hO70Uz5VD4qIMXPTGWa6xC7FzMFIZ					
Scale = 1:50.9					

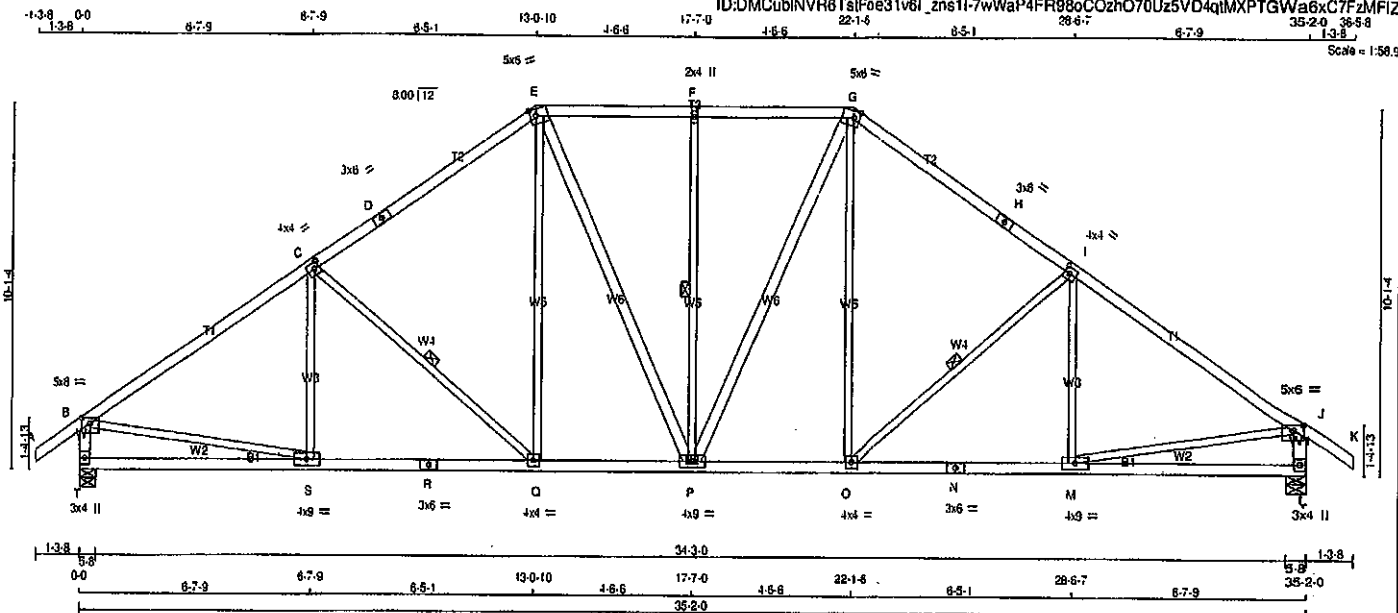

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
T - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
T - R	2x4	DRY	No.2
R - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
E - P	2x4	DRY	No.2
P - G	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMVW-p	MT20	5.0	8.0	1.75 2.75
C TMVW-l	MT20	4.0	4.0	2.00 1.50
D TS-l	MT20	3.0	8.0	
E TTWW-m	MT20	5.0	8.0	2.25 2.00
F TMVW-w	MT20	2.0	4.0	
G TTWW-m	MT20	5.0	8.0	2.25 2.00
H TS-l	MT20	3.0	8.0	
I TMVW-l	MT20	4.0	4.0	2.00 1.50
J TMVW-p	MT20	5.0	8.0	1.75 2.75
L BMV1+p	MT20	3.0	4.0	
M BMVW-l	MT20	4.0	9.0	
N BS-l	MT20	3.0	8.0	
O BMVW-l	MT20	4.0	4.0	
P BMVW-l	MT20	4.0	9.0	
Q BMVW-l	MT20	4.0	4.0	
R BS-l	MT20	3.0	8.0	
S BMVW-l	MT20	4.0	9.0	
T BMV1+p	MT20	3.0	4.0	



Structural component only
DWG# T-2007609

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
		GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
T	2065	0	2065	0	0
L	2065	0	2065	0	0

UNFACTORED REACTIONS		1ST LOOSE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
T	1458	970	0
L	1458	970	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS) T, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-Q, F-P, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED MAX CSI (LC)		
FR-TO		FROM	TO		FR-TO				
A-B	0 35	-91.8	-91.8 0.12 (1)	10.00	S-C	-189 46	0.10 (1)		
B-C	-2358 0	-91.8	-91.8 0.89 (1)	3.77	C-Q	-484 0	0.24 (1)		
C-D	-1996 0	-91.8	-91.8 0.82 (1)	4.11	Q-E	0 415	0.09 (1)		
D-E	-1996 0	-91.8	-91.8 0.82 (1)	4.11	E-P	0 315	0.05 (1)		
E-F	-1761 0	-91.8	-91.8 0.27 (1)	4.77	P-F	-502 0	0.35 (1)		
F-G	-1761 0	-91.8	-91.8 0.27 (1)	4.77	P-G	0 315	0.05 (1)		
G-H	-1996 0	-91.8	-91.8 0.82 (1)	4.11	O-G	0 415	0.09 (1)		
H-I	-1996 0	-91.8	-91.8 0.82 (1)	4.11	O-I	-484 0	0.24 (1)		
I-J	-2358 0	-91.8	-91.8 0.89 (1)	3.77	M-I	-189 46	0.10 (1)		
J-K	0 35	-91.8	-91.8 0.12 (1)	10.00	B-S	0 2021	0.45 (1)		
T-B	-2014 0	0.0	0.0 0.21 (1)	5.95	M-J	0 2021	0.45 (1)		
L-J	-2014 0	0.0	0.0 0.21 (1)	5.95					
T-S	0 0	-18.5	-18.5 0.19 (4)	10.00					
S-R	0 1995	-18.5	-18.5 0.42 (1)	10.00					
R-Q	0 1995	-18.5	-18.5 0.42 (1)	10.00					
Q-P	0 1629	-18.5	-18.5 0.32 (1)	10.00					
P-O	0 1629	-18.5	-18.5 0.32 (1)	10.00					
O-N	0 1995	-18.5	-18.5 0.42 (1)	10.00					
N-M	0 1995	-18.5	-18.5 0.42 (1)	10.00					
M-L	0 0	-18.5	-18.5 0.19 (4)	10.00					

TOTAL WEIGHT = 6 X 172 = 1030 lb

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.18")

CS: TC=0.89/1.00 (I-J:1), BC=0.42/1.00 (M-O:1), WB=0.45/1.00 (J-K:1), SS=0.24/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (J) (INPUT = 0.90)
JSI METAL = 0.87 (N) (INPUT = 1.00)

JOB NAME 408222	TRUSS NAME T8	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:00:10 2020 Page 1
 ID:DMCubINVR6TstF0e31v6l_zns11-7wWap4FR98oCOzh070Uz5VD1gIM2PTGWa6xC7FzMFIZ
 35-20 35-5-8 1-3-8
 Scale: 3/16"=1'

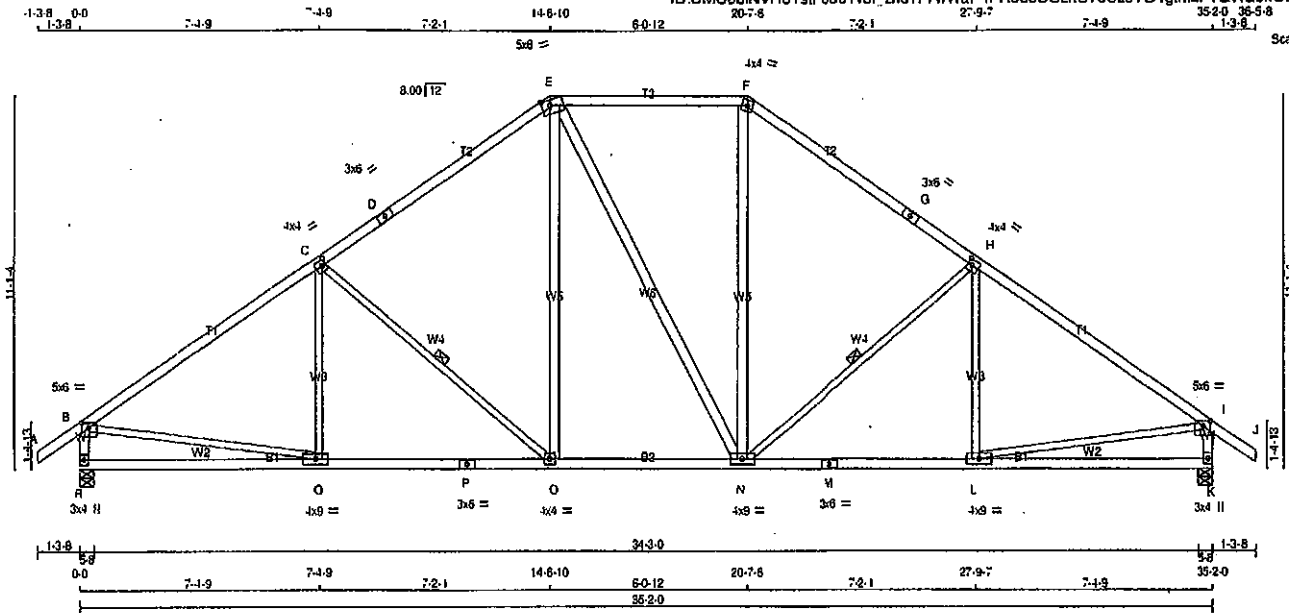

TOTAL WEIGHT = 2 X 166 = 333 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY No.2	SPF
D - E	2x4	DRY No.2	SPF
E - F	2x4	DRY No.2	SPF
F - G	2x4	DRY No.2	SPF
G - J	2x4	DRY No.2	SPF
R - B	2x4	DRY No.2	SPF
K - I	2x4	DRY No.2	SPF
R - P	2x4	DRY No.2	SPF
P - M	2x4	DRY No.2	SPF
M - K	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			
O - E	2x4	DRY No.2	SPF
E - N	2x4	DRY No.2	SPF
N - F	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMWV-p	MT20	5.0	6.0	1.75	2.75
O TMWW-I	MT20	4.0	4.0	2.00	1.50
D TS-I	MT20	3.0	6.0		
E TTWW-m	MT20	5.0	6.0	2.00	3.00
F TTW-m	MT20	4.0	4.0		
G TS-I	MT20	3.0	6.0		
H TMWW-I	MT20	4.0	4.0	2.00	1.50
I TMWV-p	MT20	5.0	6.0	1.75	2.75
K BMV-I-p	MT20	3.0	4.0		
L BMWW-I	MT20	4.0	4.0		
M BS-I	MT20	3.0	6.0		
N BMWW-I	MT20	4.0	4.0		
O BMWW-I	MT20	4.0	4.0		
P BS-I	MT20	3.0	6.0		
Q BMWW-I	MT20	4.0	4.0		
R BMV-I-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
R	2085	0	2085	0
K	2085	0	2085	0

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1458	970	0	0	0	488	0
K	1458	970	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.45 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-O, H-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	VERT. LOAD	CS (LC)	MEMB.	MAX. FACTORED	VERT. LOAD	CS (LC)
FR-TO	FORCE (LBS)	PLF	MAX	FR-TO	FORCE (LBS)	PLF	MAX
A-B	0 35	-91.8	-91.8 0.12 (1)	10.00	C-C	-140 76	0.09 (1)
B-C	-2357 0	-91.8	-91.8 0.89 (1)	3.45	O-O	-604 0	0.38 (1)
C-D	-1888 0	-91.8	-91.8 0.78 (1)	3.91	E-E	0 499	0.08 (1)
D-E	-1888 0	-91.8	-91.8 0.78 (1)	3.91	F-F	0 0	0.00 (1)
E-F	-1538 0	-91.8	-91.8 0.47 (1)	4.74	G-G	0 500	0.08 (1)
F-G	-1888 0	-91.8	-91.8 0.78 (1)	3.91	H-H	-604 0	0.38 (1)
G-H	-1888 0	-91.8	-91.8 0.78 (1)	3.91	I-I	-140 76	0.09 (1)
H-I	-2357 0	-91.8	-91.8 0.89 (1)	3.45	J-J	0 2020	0.45 (1)
I-J	0 35	-81.8	-81.8 0.12 (1)	10.00	K-K	0 2019	0.45 (1)
J-K	-2009 0	0.0	0.0 0.21 (1)	5.95			
K-L	-2009 0	0.0	0.0 0.21 (1)	5.95			
R-O	0 0	-18.5	-18.5 0.25 (4)	10.00			
O-P	0 1998	-18.5	-18.5 0.45 (1)	10.00			
P-Q	0 1998	-18.5	-18.5 0.45 (1)	10.00			
Q-N	0 1538	-18.5	-18.5 0.33 (1)	10.00			
N-M	0 1998	-18.5	-18.5 0.45 (1)	10.00			
M-L	0 1998	-18.5	-18.5 0.45 (1)	10.00			
L-K	0 0	-18.5	-18.5 0.24 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2015, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.20")

CSI: TC=0.89(1.00) (B-C:1), BC=0.45(1.00) (O-Q:1), WB=0.45(1.00) (B-Q:1), SS=0.27(1.00) (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LB SEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1687 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (F) INPUT = 0.90
 JSI METAL= 0.88 (F) INPUT = 1.00



Structural component only
 DWG# T-2007610

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T9	1	2	GREEN PARK HOMES	


Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:11 2020 Page 1

ID:DMCubINVR6TslFoe31v6l_zns1f-b64ydcQ4wSx377Gah?CeimKBHh8BztfoamgmfzMFY

1-3-8 0-0 3-9-8 3-9-8 3-7-0 7-4-8 4-10-12 12-3-4 4-9-8 4-10-12 21-11-8 3-10-8 25-10-0 27-1-8

Scale = 1:12

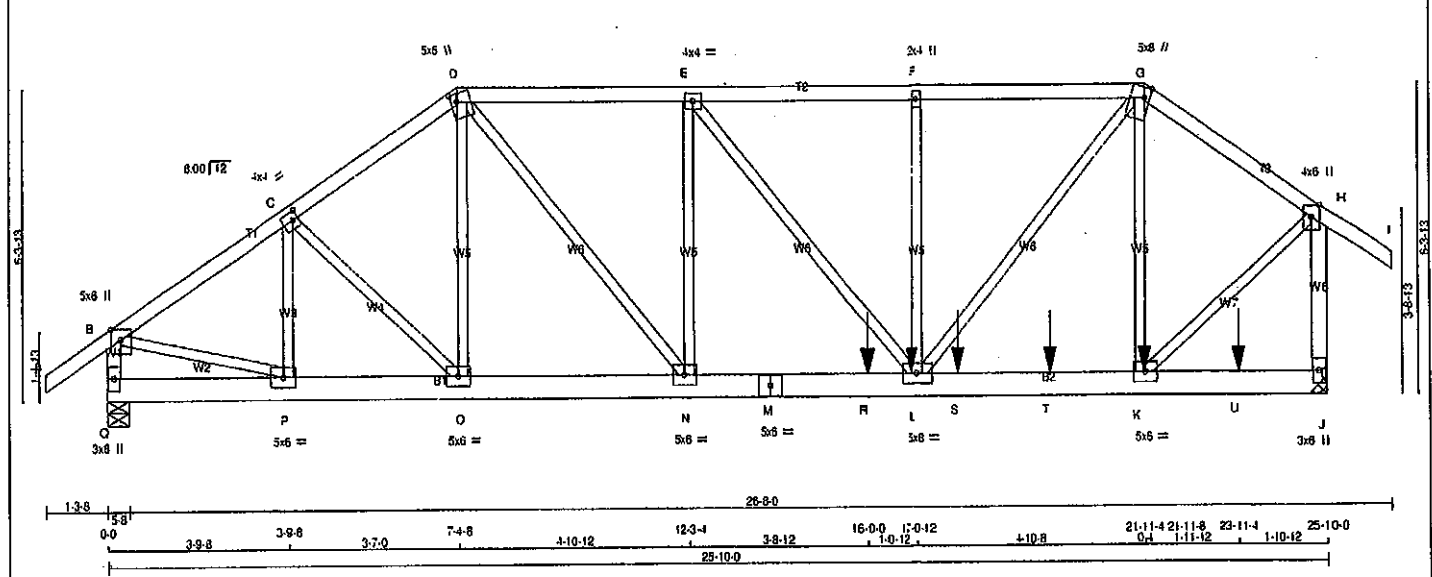

TOTAL WEIGHT = 2 X 138 = 271 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD	SPECIFIED LOADS:	
A - D	2x4	DRY	No.2	SPF	GROSS REACTION	VERT	GROSS REACTION	BRG	BRG	TOP CH. LL = 25.8 PSF	
D - G	2x4	DRY	No.2	SPF	JT VERT	1575	DOWN	0.0	0.0	DL = 6.0 PSF	
G - I	2x4	DRY	No.2	SPF	Q	2235	HORIZ	0	0	BOT CH. LL = 0.0 PSF	
I - J	2x4	DRY	No.2	SPF	J	3067	UP	0	0	DL = 7.4 PSF	
J - M	2x6	DRY	No.2	SPF						TOTAL LOAD = 39.0 PSF	
M - J	2x6	DRY	No.2	SPF						SPACING = 24.0 IN/C	
ALL WEBS	2x3	DRY	No.2	SPF							
EXCEPT											

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS SURFACE SPACING (IN) LOAD (PLF)

TOP CHORDS : (0.122"x3") SPIRAL NAILS

A-D 1 12 TOP

D-G 1 12 TOP

G-I 1 12 TOP

I-J 1 12 TOP

J-H 1 12 TOP

BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS

Q-M 2 12 TOP

M-J 2 12 TOP

WEBS : (0.122"x3") SPIRAL NAILS

2x3 1 6 SIDE (183.11)

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.97 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS

MAX. FACTORED

MEMB. FORCE

VERT. LOAD

LC1

MAX. FACTORED

CS1 (LC)

MAX. UNBRACED

LENGTH

FR-TO

A-B 0 35

B-C -2484 0

C-D -2571 0

D-E -3030 0

E-F -3235 0

F-G -3235 0

G-H -2123 0

H-I 0 35

I-J -2188 0

J-H -2962 0

Q-P 0 0

P-O 0 2087

O-N 0 2118

N-M 0 3030

M-R 0 3030

R-L 0 3030

L-S 0 1746

S-T 0 1746

T-K 0 1746

K-U 0 0

U-J 0 0

W-B -603 0

B-C 0 70

C-D 0 60

D-E 0 1433

E-F -736 0

F-G 0 327

G-H -169 0

H-I 0 2339

I-J -995 0

J-K 0 2137

K-H 0 2299

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019

- PART 9 OF OBC 2012 (2019 AMENDMENT)

- CSA 088-09, CSA 086-14

- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.86")

CALCULATED VERT. DEFL.(LL) = L/999 (0.08")

ALLOWABLE DEFL.(TL) = L/360 (0.86")

CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CS1: TO=0.33/1.00 (H-J:1), BC=0.45/1.00 (L-N:1), WB=0.30/1.00 (G-K:1), SS=0.35/1.00 (L-N:1)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSH) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.81 (H) (INPUT = 0.80)

JSI METAL = 0.53 (H) (INPUT = 1.00)

FACTORED CONCENTRATED LOADS (LBS)

JT LOC. LC1 MAX. MAX+ FACE DIR. TYPE HEEL CONN.

K 21-11-4 -187 -187 --- FRONT VERT TOTAL --- C1

L 16-11-4 -187 -187 --- FRONT VERT TOTAL --- C1

R 16-0-0 -1259 -1259 --- FRONT VERT TOTAL --- C1

S 17-11-4 -187 -187 --- FRONT VERT TOTAL --- C1

T 19-11-4 -187 -187 --- FRONT VERT TOTAL --- C1

U 23-11-4 -195 -195 --- FRONT VERT TOTAL --- C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

STRUCTURAL COMPONENT ONLY

DWG# T-2007611

CONTINUED ON PAGE 2

PROVINCE OF ONTARIO

04/18/10

H. J. G. ALVES

100009024

PROVINCE OF ONTARIO

Structural component only

DWG# T-2007611

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T9	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.3 10 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:00:11 2020 Page 2

ID:DMCubINVR6TstFog31v6I zns1I-b64ydQG4wSx3?7Gah?CelmKBHhBBzIfmgmIizMFIY

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	Edge	
C	TMWW-l	MT20	4.0	4.0	2.00	1.50
D	TTWW+m	MT20	5.0	6.0	2.00	1.50
E	TMWW-l	MT20	4.0	4.0		
F	TMW+u	MT20	2.0	4.0		
G	YTWW+m	MT20	5.0	8.0	2.50	1.50
H	TMVW+p	MT20	4.0	6.0	Edge	
J	BMV1+p	MT20	3.0	6.0		
K, N, O, P						
K	BMWW-l	MT20	5.0	6.0		
L	BMWWW-l	MT20	5.0	8.0		
M	BS-l	MT20	5.0	6.0		
Q	BMV1+p	MT20	3.0	6.0		


Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.



Structural component only
DWG# T-2007611

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T10	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 5 Oct 29 2019 MITek Industries, Inc. Tue Apr 28 08:00:12 2020 Page 1
ID:DMCubINVR6TslFoe31v6l zns1f-4leLqmGhm3wdHrmERWRAwIUkh4GILtp2QOJB8zMFIX

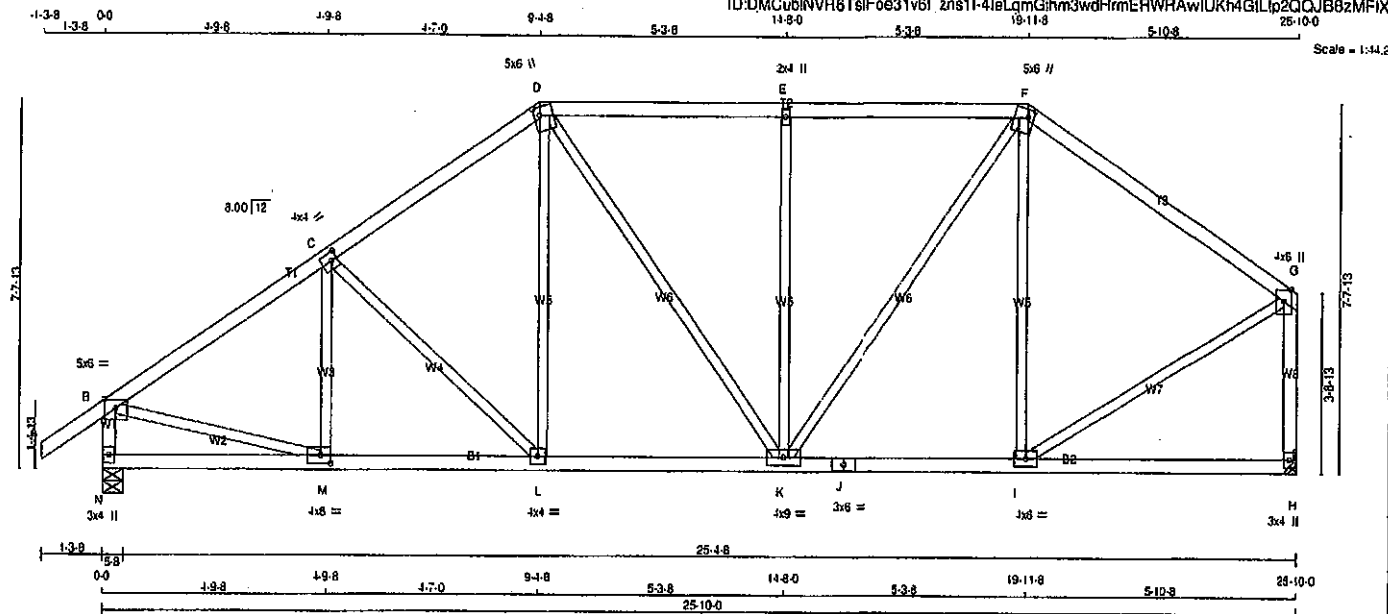

TOTAL WEIGHT = 118 lb (M/F)

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No. 2
D - F	2x4	DRY	No. 2
F - G	2x4	DRY	No. 2
N - B	2x4	DRY	No. 2
H - G	2x4	DRY	No. 2
N - J	2x4	DRY	No. 2
J - H	2x4	DRY	No. 2
ALL WEBS	2x3	DRY	No. 2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	Edge	
C	TMVW-l	MT20	4.0	4.0	2.00	1.50
D	TTWW+m	MT20	5.0	6.0	2.00	1.50
E	TMVW-w	MT20	2.0	4.0		
F	TTWW+m	MT20	5.0	6.0	2.00	1.50
G	TMVW-p	MT20	4.0	6.0	Edge	
H	BMV1-p	MT20	3.0	4.0		
I	BMVW-l	MT20	4.0	6.0		
J	BS-l	MT20	3.0	6.0		
K	BMVW-w	MT20	4.0	6.0		
L	BMVW-l	MT20	4.0	4.0		
M	BMVW-l	MT20	4.0	6.0	2.00	2.50
N	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
N	1550	0	1550	0	5-8
H	1424	0	1424	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
N	1094	731.0	0.0	0.0	0.0	383.0
H	1007	681.0	0.0	0.0	0.0	346.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.93 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO	FROM TO	FR-TO	FROM TO
A-B	0 35	M-C	-217 3
B-C	-1609 0	C-L	-273 0
C-D	-1425 0	L-D	0 280
D-E	-1272 0	D-K	0 165
E-F	-1272 0	K-E	-595 0
F-G	-1077 0	K-F	0 655
G-H	-1511 0	I-F	-390 0
H-G	-1380 0	B-M	0 1386
		I-G	0 1031
N-M	0 0		
M-L	0 1362		
L-K	0 1164		
K-J	0 890		
J-I	0 890		
I-H	0 0		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9. NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD.

ALLOWABLE DEFL. (LL) = L/360 (0.86")
CALCULATED VERT. DEFL. (LL) = L/999 (0.05")
ALLOWABLE DEFL. (TL) = L/360 (0.86")
CALCULATED VERT. DEFL. (TL) = L/999 (0.09")

CSI: TC=0.43 (1.00 (F-G:1)), BC=0.27 (1.00 (L-M:1)),
WB=0.84 (1.00 (E-K:1)), SSI=0.23 (1.00 (E-F:1))

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	618	354	1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.280 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (B) INPUT = 0.90
JSI METAL= 0.56 (G) INPUT = 1.00




Structural component only
DWG# T-2007612.

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T11A	2	1	TRUSS DESC.		

Famarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:12 2020 Page 1

ID:DMCubINVR6TstFoe31v6I zns11-4leLqmGihm3wdHmERWRawIXHh2PIN5p2QQJB8zMFIX

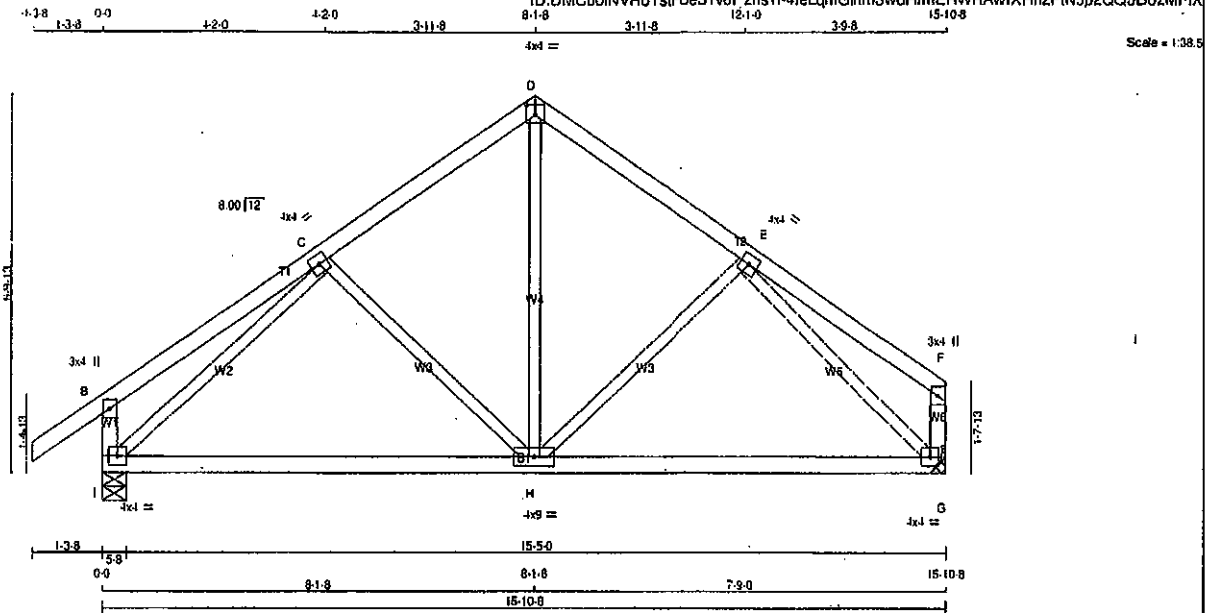

TOTAL WEIGHT = 2 X 68 = 133 lb (M/F)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
I - B	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	
I - G	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table in inches)	W	LEN	Y	X
JT TYPE PLATES				
B TMV-vp MT20	3.0	4.0		
C TMWV-1 MT20	4.0	4.0		
D TMW-vp MT20	4.0	4.0	2.25	2.00
E TMWV-1 MT20	4.0	4.0		
F TMV-vp MT20	3.0	4.0		
G BMWV-1 MT20	4.0	4.0		
H BMWVW-1 MT20	4.0	9.0		
I BMWV-1 MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
I	1001	0	1001	0
G	875	0	875	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	708	476	0	0	0	229	0
G	619	408	0	0	0	213	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. UNBRACED LENGTH (FT)
FR-TO		FROM TO		FR-TO		FROM TO	
A-B	0 35	-91.8 -91.8	0.12 (1)	10.00	C-H	-228 0	0.12 (1)
B-C	0 24	-91.8 -91.8	0.24 (1)	10.00	H-D	0 449	0.10 (1)
C-D	-691 0	-91.8 -91.8	0.19 (1)	6.25	H-E	-166 0	0.09 (1)
D-E	-689 0	-91.8 -91.8	0.17 (1)	6.25	I-C	-988 0	0.50 (1)
E-F	0 24	-91.8 -91.8	0.22 (1)	10.00	E-G	-971 0	0.44 (1)
I-B	-269 0	0.0 0.0	0.03 (1)	7.81			
G-F	-125 0	0.0 0.0	0.01 (1)	7.81			
I-H	0 722	-18.5 -18.5	0.39 (4)	10.00			
H-G	0 677	-18.5 -18.5	0.39 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	8.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.53")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.53")
CALCULATED VERT. DEFL.(TL) = L/999 (0.1")

CSI: TC=0.24/1.00 (B-C:1), BC=0.39/1.00 (H-I:4), WB=0.50/1.00 (C-I:1), SS=0.15/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618 354 1667 788 1987 1658	

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (E) (INPUT = 0.90)
JSI METAL= 0.35 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007613

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T11B	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

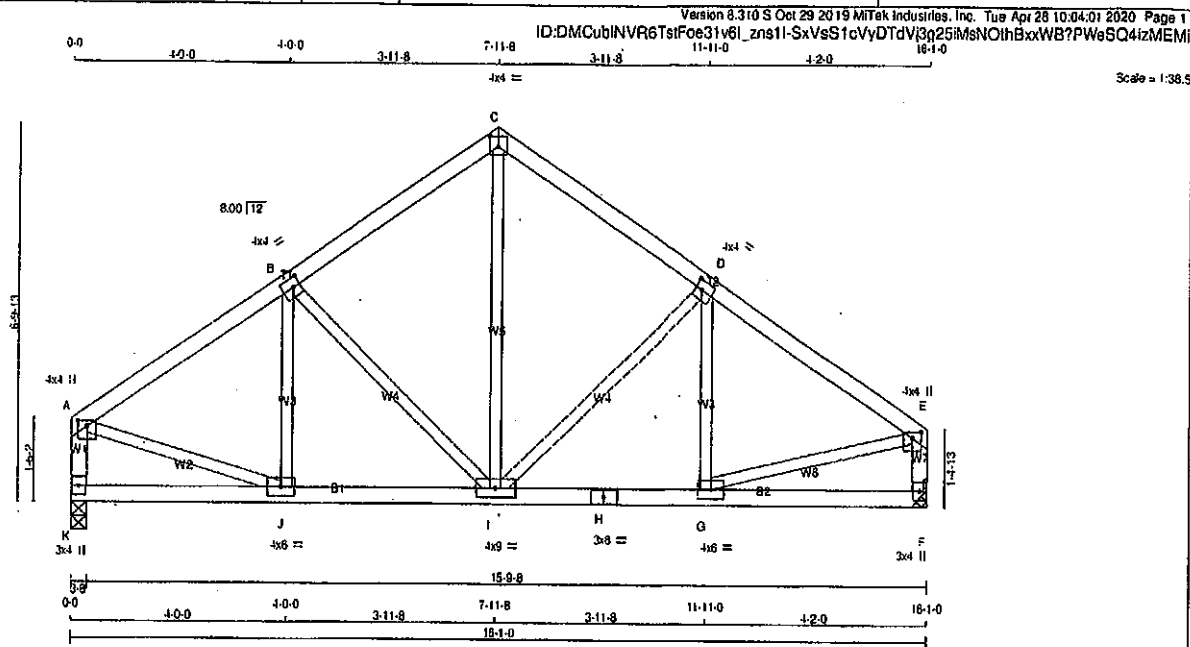

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
K - A	2x4	DRY	No.2
F - E	2x4	DRY	No.2
K - H	2x4	DRY	No.2
H - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-p	MT20	4.0	4.0	1.25 2.00
B	TMVW-l	MT20	4.0	4.0	2.00 1.50
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TMVW-l	MT20	4.0	4.0	2.00 1.50
E	TMVW-p	MT20	4.0	4.0	1.25 2.00
F	BMV1-p	MT20	3.0	4.0	
G	BMVW-l	MT20	4.0	6.0	
H	BS-l	MT20	3.0	6.0	
I	BMVW-l	MT20	4.0	9.0	
J	BMVW-l	MT20	4.0	6.0	
K	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
K	887	0	887	0	3-8
F	887	0	887	0	3-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	627	411 0	0 0	0 0	0 0	216 0	0 0	0 0
F	627	411 0	0 0	0 0	0 0	216 0	0 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	-868 0	J-B	-142 18
B-C	-687 0	B-I	-263 0
C-D	-888 0	I-C	0 481
D-E	-891 0	I-D	-292 0
K-A	-855 0	G-D	-117 28
F-E	-853 0	A-J	0 772
		G-E	0 787
K-J	0 0		
J-I	0 740		
I-H	0 761		
H-G	0 781		
G-F	0 0		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/G

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.54")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CS: TC=0.20/1.00 (D-E:1), BC=0.15/1.00 (G-I:1), WB=0.18/1.00 (E-G:1), SS=0.15/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (E) (INPUT = 0.90)
JSI METAL= 0.25 (H) (INPUT = 1.00)



Structural component only
DWG# T-2007631


Tamarack Roof Truss, Burlington



JOB NAME 408222	TRUSS NAME T12S	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 08:00:14 2020 Page 1

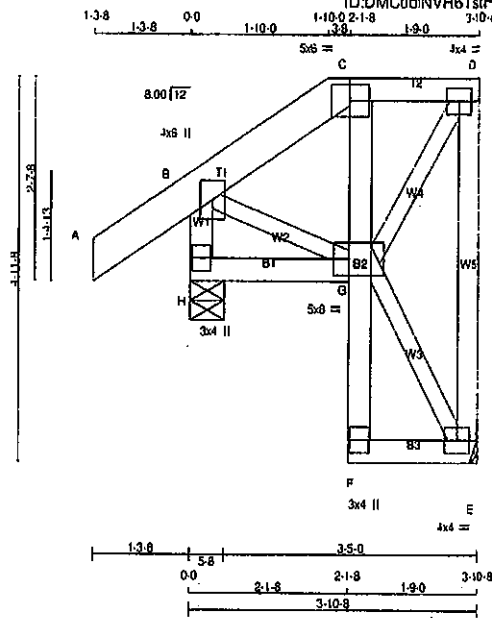

Scale = 1/2" = 1'-0"

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR
A - C	2x8	DRY	No.2	SPF		
C - D	2x4	DRY	No.2	SPF		
E - D	2x4	DRY	No.2	SPF		
H - B	2x4	DRY	No.2	SPF		
H - G	2x4	DRY	No.2	SPF		
F - C	2x4	DRY	No.2	SPF		
F - E	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						

DRY: SEASONED LUMBER.

PLATES (table in inches)	W	LEN	Y	X
JT TYPE				
B TMW+p	MT20	4.0	6.0	
C TTV-m	MT20	5.0	6.0	
D TMW-l	MT20	4.0	4.0	
E BMW-l	MT20	4.0	4.0	
F BMW+p	MT20	3.0	4.0	
G BMW-l	MT20	5.0	8.0	2.50 2.50
H BMW-l	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORIZ	DOWN	HORIZ
E	214	0	214	0
H	344	0	344	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1'-8".

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	151	99	0	0	0	0	52
H	241	172	0	0	0	0	69

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. LC1 (LC)	MAX. UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)
FR-TO						FR-TO			
A-B	0	36	-91.8	-91.8	0.07 (5)	10.00	G-D	0	139
B-C	-105	0	-91.8	-91.8	0.03 (1)	6.25	B-G	0	96
C-D	-79	0	-91.8	-91.8	0.05 (1)	8.25	G-E	-3	0
E-D	-196	0	0.0	0.0	0.08 (1)	7.81			
H-B	-323	0	0.0	0.0	0.03 (1)	7.81			
H-G	0	0	-18.5	-18.5	0.03 (4)	10.00			
F-G	0	17	0.0	0.0	0.01 (1)	10.00			
G-C	-119	0	0.0	0.0	0.01 (1)	7.81			
F-E	0	2	-18.5	-18.5	0.01 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 31 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.03/1.00 (D-E:1), BC=0.03/1.00 (G-H:1), WB=0.03/1.00 (D-G:1), SSI=0.07/1.00 (A-B:5)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1067 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.19 (B) INPUT = 0.90
JSI METAL = 0.11 (B) INPUT = 1.00




Structural component only
DWG# T-2007615

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T20	1	2	GREEN PARK HOMES	
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 26 10:04:02 2020 Page 1

ID:DMCubINVR6TslF0e31v6l zns11-x73EgNd7XbU8sesc0bPawOPaBNFZ7YIIB c6zMEMh

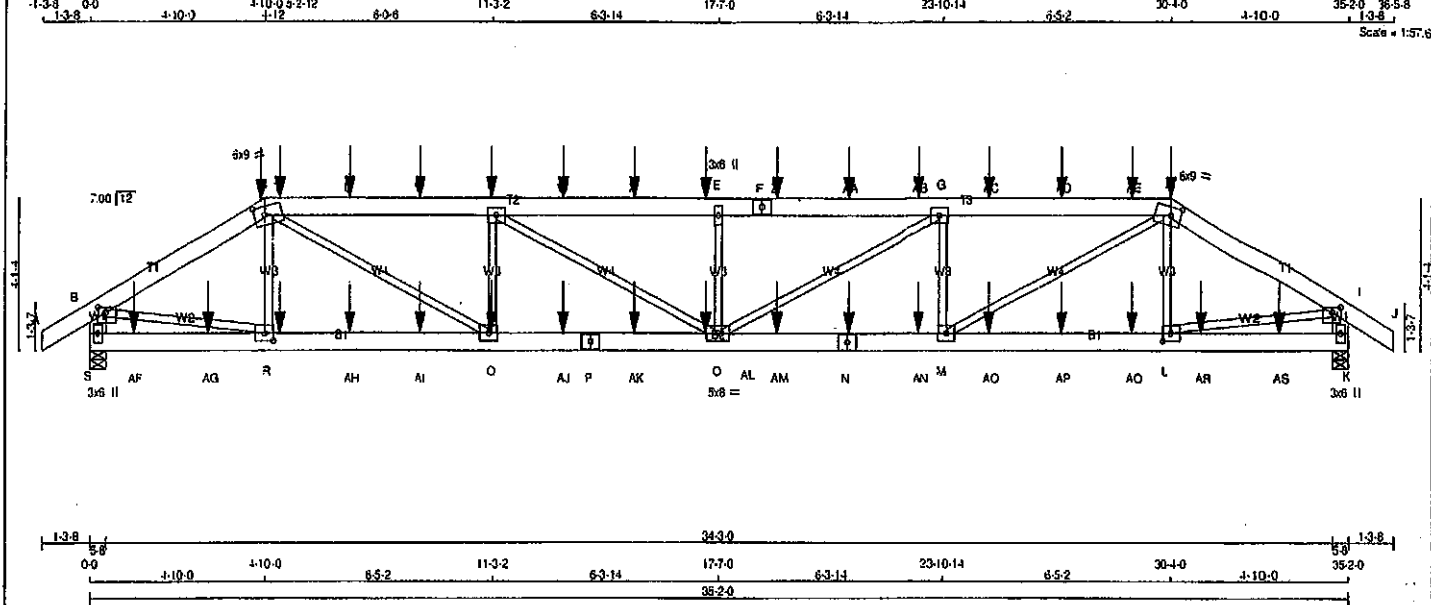

TOTAL WEIGHT = 2 X 180 = 359 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x6	DRY	No.2
C - F	2x6	DRY	No.2
F - H	2x6	DRY	No.2
H - J	2x6	DRY	No.2
S - B	2x6	DRY	No.2
K - I	2x6	DRY	No.2
S - P	2x6	DRY	No.2
P - N	2x6	DRY	No.2
N - K	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	2	12
C - F	2	12
F - H	2	12
H - J	2	12
S - B	2	12
K - I	2	12
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S - P	2	12
P - N	2	12
N - K	2	12
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	1	6

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
S	3423	0	3423	0	5-8
K	3365	0	3365	0	5-8

UNFACTORED REACTIONS		1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	2418	1600	0	0	0	0	818
K	2378	1573	0	0	0	0	804

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.03 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING		CHORDS	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. (PLF)	MEMB.	FORCE (LBS)
FR-TO				FR-TO	
A-B	0 33	-91.8	-91.8 0.04 (1)	R-C	-431 9
B-C	-4681 0	-91.8	-91.8 0.13 (1)	C-Q	0 3534
C-T	-7102 0	-91.8	-91.8 0.31 (1)	Q-D	-1555 0
T-U	-7102 0	-91.8	-91.8 0.31 (1)	D-O	0 1048
U-V	-7102 0	-91.8	-91.8 0.31 (1)	O-E	-884 0
V-D	-7102 0	-91.8	-91.8 0.31 (1)	E-G	0 1065
D-W	-8010 0	-91.8	-91.8 0.32 (1)	G-H	-1573 0
W-X	-8010 0	-91.8	-91.8 0.32 (1)	H-I	0 3572
X-Y	-8010 0	-91.8	-91.8 0.32 (1)	I-L	-421 10
Y-E	-8010 0	-91.8	-91.8 0.32 (1)	E-G	0 4088
E-F	-8010 0	-91.8	-91.8 0.33 (1)	L-I	0 -4022
F-Z	-8010 0	-91.8	-91.8 0.33 (1)		
Z-AA	-8010 0	-91.8	-91.8 0.33 (1)		
AA-AB	-8010 0	-91.8	-91.8 0.33 (1)		
AB-G	-8010 0	-91.8	-91.8 0.33 (1)		
G-AC	-7070 0	-91.8	-91.8 0.30 (1)		
AC-AD	-7070 0	-91.8	-91.8 0.30 (1)		
AD-AE	-7070 0	-91.8	-91.8 0.30 (1)		
AE-H	-7070 0	-91.8	-91.8 0.30 (1)		
H-I	-4606 0	-91.8	-91.8 0.13 (1)		
I-J	0 33	-91.8	-91.8 0.04 (1)		
S-B	-3367 0	0.0	0.0 0.12 (1)		
K-I	-3318 0	0.0	0.0 0.12 (1)		

S-AF	0 0	-18.5	-18.5 0.06 (4)	10.00
AF-AG	0 0	-18.5	-18.5 0.06 (4)	10.00
AG-R	0 0	-18.5	-18.5 0.06 (4)	10.00
R-AH	0 4024	-18.5	-18.5 0.31 (1)	10.00
AH-AI	0 4024	-18.5	-18.5 0.31 (1)	10.00
AI-O	0 4024	-18.5	-18.5 0.31 (1)	10.00
O-AJ	0 7102	-18.5	-18.5 0.52 (1)	10.00
AJ-P	0 7102	-18.5	-18.5 0.52 (1)	10.00
P-AK	0 7102	-18.5	-18.5 0.52 (1)	10.00
AK-AL	0 7102	-18.5	-18.5 0.52 (1)	10.00
AL-O	0 7102	-18.5	-18.5 0.52 (1)	10.00
O-AM	0 7070	-18.5	-18.5 0.52 (1)	10.00
AM-N	0 7070	-18.5	-18.5 0.52 (1)	10.00
N-AN	0 7070	-18.5	-18.5 0.52 (1)	10.00
AN-M	0 7070	-18.5	-18.5 0.52 (1)	10.00
M-AO	0 3960	-18.5	-18.5 0.30 (1)	10.00
AO-AP	0 3960	-18.5	-18.5 0.30 (1)	10.00
AP-AO	0 3960	-18.5	-18.5 0.30 (1)	10.00
AO-L	0 3960	-18.5	-18.5 0.30 (1)	10.00

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDTL. USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD
EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (11.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.20")
ALLOWABLE DEFL.(TL) = L/360 (11.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.37")

CSI: TC=0.33/1.00 (E-G); BC=0.52/1.00 (O-Q); WB=0.51 1.00 (B-R); SS=0.18/1.00 (G-H);

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 518 354 1687 788 1987 1686

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.89 (Q) (INPUT = 0.90)
JSI METAL=0.68 (P) (INPUT = 1.00)

CONTINUED ON PAGE 2

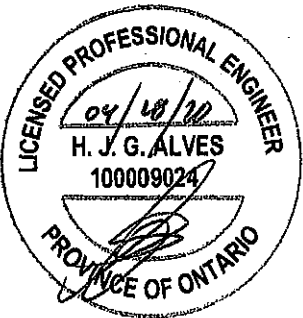

Structural component only
DWG# T-2007632 1/2

JOB NAME

408223

TRUSS NAME

T20

QUANTITY

1

PLY

2

JOB DESC.

GREEN PARK HOMES

DRWG NO.

Tamarack Roof Truss, Burlington

Version 8.316 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:04:02 2020 Page 2

ID:DMCub\NVR6Ts\Foe31v8I zns1l-x73EqNd7XbU6sasc0DbPaw0PaBNFZ7YHB c8zMEMh

PLATES (kilo is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	2.75
C	TTWW-m	MT20	6.0	9.0	2.75	3.50
D	TMWW-l	MT20	5.0	6.0		
E	TMW-w	MT20	3.0	6.0		
F	TS-l	MT20	5.0	6.0		
G	TMWW-l	MT20	5.0	6.0		
H	TTWW-m	MT20	6.0	9.0	2.75	3.50
I	TMVW-p	MT20	5.0	6.0	1.75	2.75
K	BMV1-p	MT20	3.0	6.0		
L	BMWW-l	MT20	5.0	6.0	2.50	2.75
M	BMWW-l	MT20	5.0	6.0		
N	BS-l	MT20	5.0	6.0		
O	BMWWW-l	MT20	5.0	6.0		
P	BS-l	MT20	5.0	6.0		
Q	BMWW-l	MT20	5.0	6.0		
R	BMWW-l	MT20	5.0	6.0	2.50	2.75
S	BMV1-p	MT20	3.0	6.0		

LOADING

TOTAL LOAD CASES: (4)

CHORDS

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX	MAX. UNBRAC
FR-TO		FROM TO			LENGTH FR-TO
L-AR	0 0	-18.5 -18.5	0.06 (4)	10.00	
AR-AS	0 0	-18.5 -18.5	0.06 (4)	10.00	
AS-K	0 0	-18.5 -18.5	0.06 (4)	10.00	

WEBS

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX	MAX. UNBRAC
FR-TO		FROM TO			LENGTH FR-TO
L-AR	0 0	-18.5 -18.5	0.06 (4)	10.00	
AR-AS	0 0	-18.5 -18.5	0.06 (4)	10.00	
AS-K	0 0	-18.5 -18.5	0.06 (4)	10.00	

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-10-0	-60	-67	---	FRONT	VERT	DEAD	---	C1
C	4-10-0	-311	-311	---	FRONT	VERT	SNOW	---	C1
D	11-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	30-4-0	-60	-67	---	FRONT	VERT	DEAD	---	C1
H	30-4-0	-311	-311	---	FRONT	VERT	SNOW	---	C1
N	21-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
O	11-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
R	5-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	5-2-12	-138	-138	---	FRONT	VERT	TOTAL	---	C1
U	7-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	9-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	13-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	15-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	17-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	19-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	21-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	29-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	1-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	3-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	7-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	9-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	13-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	15-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AL	17-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AM	19-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AN	23-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AO	25-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AP	27-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AQ	29-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AR	31-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AS	33-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) G1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

LICENSED PROFESSIONAL ENGINEER

04/28/22

H. J. G. ALVES

100009024

PROVINCE OF ONTARIO


Structural component only

DWG# T-2007632

JOB NAME 408223	TRUSS NAME T21	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:04:03 2020 Page 1
ID:DMCubiNVR6TsiFoa31v8I zns11-PK00tJelUgJLk0D3AWiqxoT6J Vvk xSI yxX9bzMEMg
3520 3658
1.38
Scale = 1:57.6

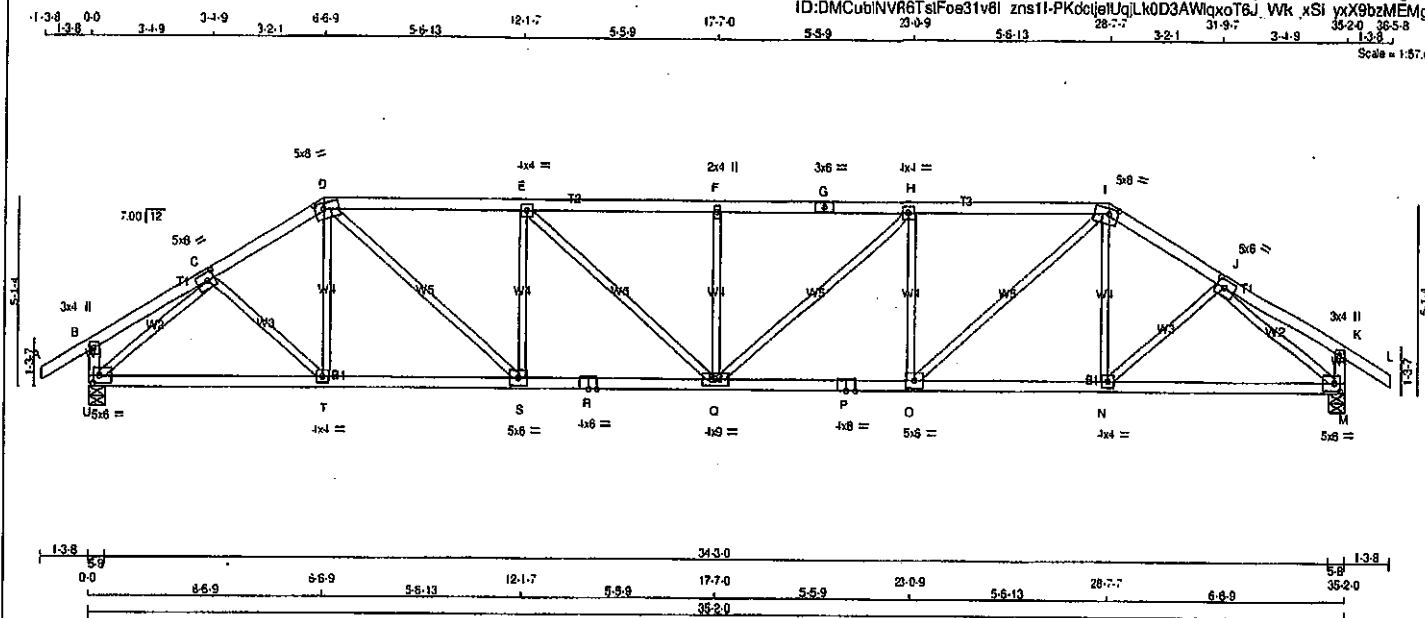

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
U - B	2x4	DRY	No.2
M - K	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - P	2x4	DRY	No.2
P - M	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (Table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVvp	MT20	3.0	4.0		
C	TMWW-I	MT20	5.0	8.0	2.50	2.50
D	TTWW-m	MT20	5.0	8.0	1.75	3.00
E	TMWW-I	MT20	4.0	4.0		
F	TMWW-w	MT20	2.0	4.0		
G	TS-I	MT20	3.0	6.0		
H	TMWW-I	MT20	4.0	4.0		
I	TTWW-m	MT20	5.0	8.0	1.75	3.00
J	TMWW-I	MT20	5.0	8.0	2.50	2.50
K	TMVvp	MT20	3.0	4.0		
M	BMVW-I	MT20	5.0	8.0	2.50	2.00
N	BMWW-I	MT20	4.0	4.0		
O	BMWW-I	MT20	5.0	8.0		
P	BS-I	MT20	4.0	6.0		
R	BS-I	MT20	4.0	6.0		
S	BMWW-I	MT20	5.0	8.0		
T	BMWW-I	MT20	4.0	4.0		
U	BMVW-I	MT20	5.0	8.0	2.50	2.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	HORZ	GROSS REACTION	JT	VERT	HORZ	GROSS REACTION	JT	VERT
U	2064	0	2064	0	0	0	5-8	5-8	5-8
M	2064	0	2064	0	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
U	1457	970	0
M	1457	970	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.12 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (LBS)	MAX. CSI (LC)	MEMB.	MAX. FORCE (LBS)	VERT. LOAD (LBS)	MAX. CSI (LC)
FR-TO				FR-TO			
A-B	0 32	-91.8	-91.8 0.12 (1)	C-T	0 213	0.05 (1)	
B-C	0 13	-91.8	-91.8 0.12 (1)	T-D	-8 69	0.02 (4)	
C-D	-2527 0	-91.8	-91.8 0.20 (1)	D-S	0 1447	0.33 (1)	
D-E	-3284 0	-91.8	-91.8 0.66 (1)	S-E	-853 0	0.33 (1)	
E-F	-3595 0	-91.8	-91.8 0.70 (1)	F-Q	0 428	0.10 (1)	
F-G	-3595 0	-91.8	-91.8 0.70 (1)	Q-P	-482 0	0.18 (1)	
G-H	-3595 0	-91.8	-91.8 0.70 (1)	H-Q	0 428	0.10 (1)	
H-I	-3284 0	-91.8	-91.8 0.66 (1)	Q-H	-853 0	0.33 (1)	
I-J	-2527 0	-91.8	-91.8 0.20 (1)	I-L	0 1447	0.33 (1)	
J-K	0 13	-91.8	-91.8 0.12 (1)	L-I	-8 69	0.02 (4)	
K-L	0 32	-91.8	-91.8 0.12 (1)	L-J	0 213	0.05 (1)	
U-B	-249 0	0.0	0.0 0.03 (1)	U-C	-2671 0	0.82 (1)	
M-K	-249 0	0.0	0.0 0.03 (1)	J-M	-2671 0	0.82 (1)	
U-T	0 2005	-18.5	-18.5 0.42 (1)				
T-S	0 2167	-18.5	-18.5 0.44 (1)				
S-R	0 3284	-18.5	-18.5 0.58 (1)				
R-Q	0 3284	-18.5	-18.5 0.58 (1)				
Q-P	0 3284	-18.5	-18.5 0.58 (1)				
P-O	0 3284	-18.5	-18.5 0.58 (1)				
O-N	0 2167	-18.5	-18.5 0.44 (1)				
N-M	0 2005	-18.5	-18.5 0.42 (1)				

TOTAL WEIGHT = 142 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/989 (0.39")

CSI: TC=0.70(1.00) (E-F:1), 8C=0.58(1.00) (Q-S:1),
WB=0.82(1.00) (J-M:1), SS=0.24(1.00) (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.90 (M) (INPUT = 0.90)
JSI METAL = 0.74 (R) (INPUT = 1.00)



Structural component only
DWG# T-2007633

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T22	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitel Industries, Inc. Tue Apr 28 10:04:04 2020 Page 1
 ID:DMCubINVR6TsFoe31v8l zns11tWB743eNF8rCMAOfJG3U70GFOtjTtrCcg4htzMEMI
 20-7-14 35-2-0 35-5-8
 Scale = 1:57.6

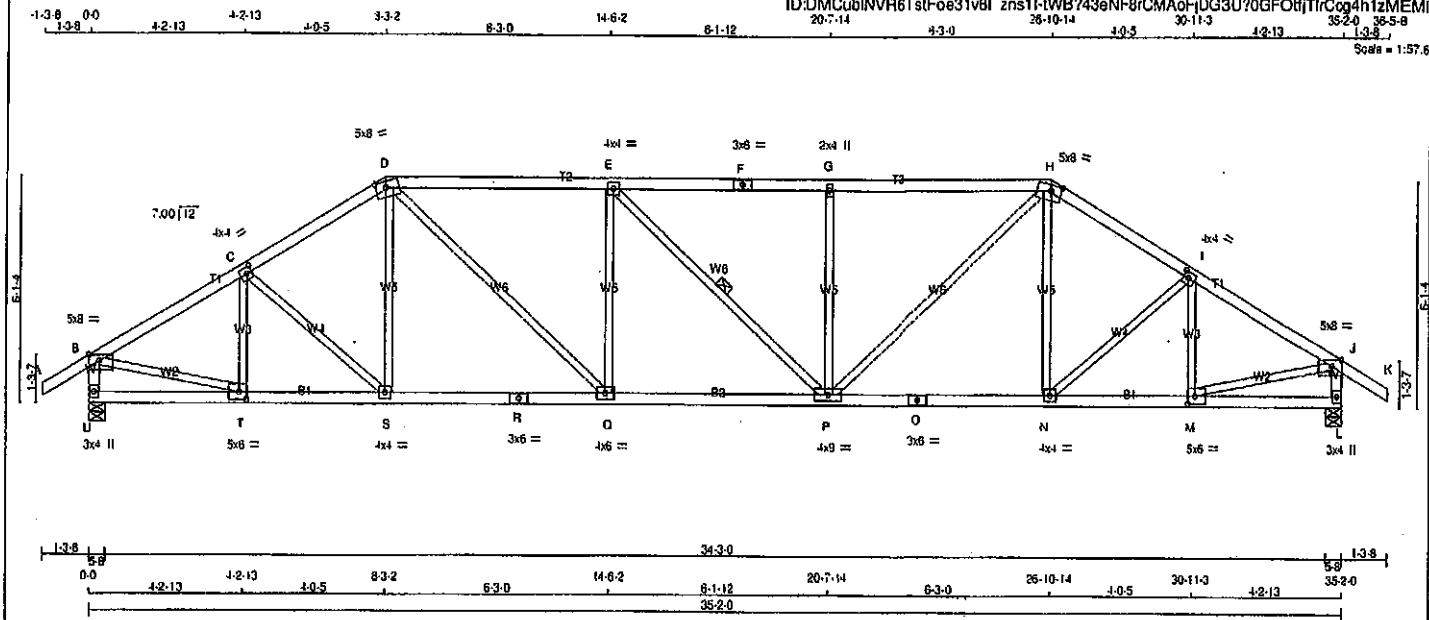


LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
U - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	8.0 Edge 3.50
C	TMVW-l	MT20	4.0	4.0 2.00 1.75
D	TTWW-m	MT20	5.0	8.0 2.00 3.50
E	TMVW-l	MT20	4.0	4.0
F	TS-l	MT20	3.0	8.0
G	TMVW-w	MT20	2.0	4.0
H	TTWW-m	MT20	5.0	8.0 2.00 3.50
I	TMVW-l	MT20	4.0	4.0 2.00 1.75
J	TMVW-p	MT20	5.0	8.0 Edge 3.50
L	BMV-l-p	MT20	3.0	4.0
M	BMVW-l	MT20	5.0	6.0 2.50 2.50
N	BMVW-l	MT20	4.0	4.0
O	BS-l	MT20	3.0	6.0
P	BMVW-w-l	MT20	4.0	9.0
Q	BMVW-l	MT20	4.0	6.0
R	BS-l	MT20	3.0	6.0
S	BMVW-w-l	MT20	4.0	4.0
T	BMVW-l	MT20	5.0	6.0 2.50 2.50
U	BMV-l-p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

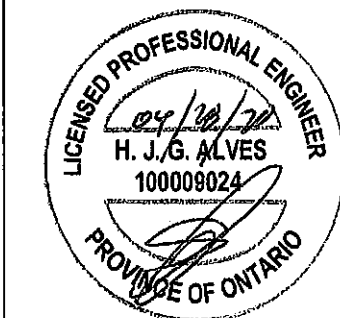

Structural component only
 DWG# T-2007634

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS	REACTION	DOWN	HORIZ	BRG	IN-SX	IN-SX	IN-SX
U	2064	0	2064	0	0	5-8	5-8	5-8	5-8
L	2064	0	2064	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST CASE		MAX./MIN. COMPONENT REACTIONS		LIVE		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW
U	1457	970	0	0	0	0	0	0	0	0	0	0	488	0	0
L	1457	970	0	0	0	0	0	0	0	0	0	0	488	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.37 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1:2 LENGTH OF E-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
 TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	LG1 (LBS)	MAX. (LBS)	MEMB.	FORCE (LBS)	MAX. (LBS)
FR-TO		FROM	TO	LENGTH	FR-TO		
A-B	0 32	-91.8	-91.8	0.12 (1)	10.00	T-C	-426 0
B-C	-2468 0	-91.8	-91.8	0.35 (1)	4.07	C-S	-39 0
C-D	-2478 0	-91.8	-91.8	0.34 (1)	4.08	S-D	0 131
D-E	-2910 0	-91.8	-91.8	0.75 (1)	3.37	D-Q	0 1076
E-F	-2909 0	-91.8	-91.8	0.74 (1)	3.38	Q-E	-617 0
F-G	-2909 0	-91.8	-91.8	0.74 (1)	3.38	E-P	-2 0
G-H	-2909 0	-91.8	-91.8	0.75 (1)	3.38	P-G	-617 0
H-I	-2478 0	-91.8	-91.8	0.34 (1)	4.08	I-H	0 1073
I-J	-2468 0	-91.8	-91.8	0.35 (1)	4.07	H-N	0 132
J-K	0 32	-91.8	-91.8	0.12 (1)	10.00	N-I	-39 0
U-B	-2025 0	0.0	0.0	0.21 (1)	5.94	M-I	-426 0
L-J	-2025 0	0.0	0.0	0.21 (1)	5.94	B-T	0 2205
U-T	0 0	-18.5	-18.5	0.07 (4)	10.00	M-J	0 2205
T-S	0 2149	-18.5	-18.5	0.41 (1)	10.00		
S-R	0 2122	-18.5	-18.5	0.41 (1)	10.00		
R-O	0 2122	-18.5	-18.5	0.41 (1)	10.00		
O-P	0 2910	-18.5	-18.5	0.54 (1)	10.00		
P-O	0 2122	-18.5	-18.5	0.41 (1)	10.00		
O-N	0 2122	-18.5	-18.5	0.41 (1)	10.00		
N-M	0 2149	-18.5	-18.5	0.41 (1)	10.00		
M-L	0 0	-18.5	-18.5	0.07 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, OBC 2012, ABC 2018
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.16")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.30")

CSI: TC=0.75:1.00 (D-E:1), BC=0.54:1.00 (P-Q:1), WB=0.50:1.00 (B-T:1), SS=0.27:1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.69 (T); INPUT = 0.99)
 JSI METAL= 0.70 (O); INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T23	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:04:06 2020 Page 1
ID:DMCubINVR8TstFoe31v61 zns11-pvjIVkgeml5wbUyareIXZQ5aqCaVBjG8gw9BlvzMEMd

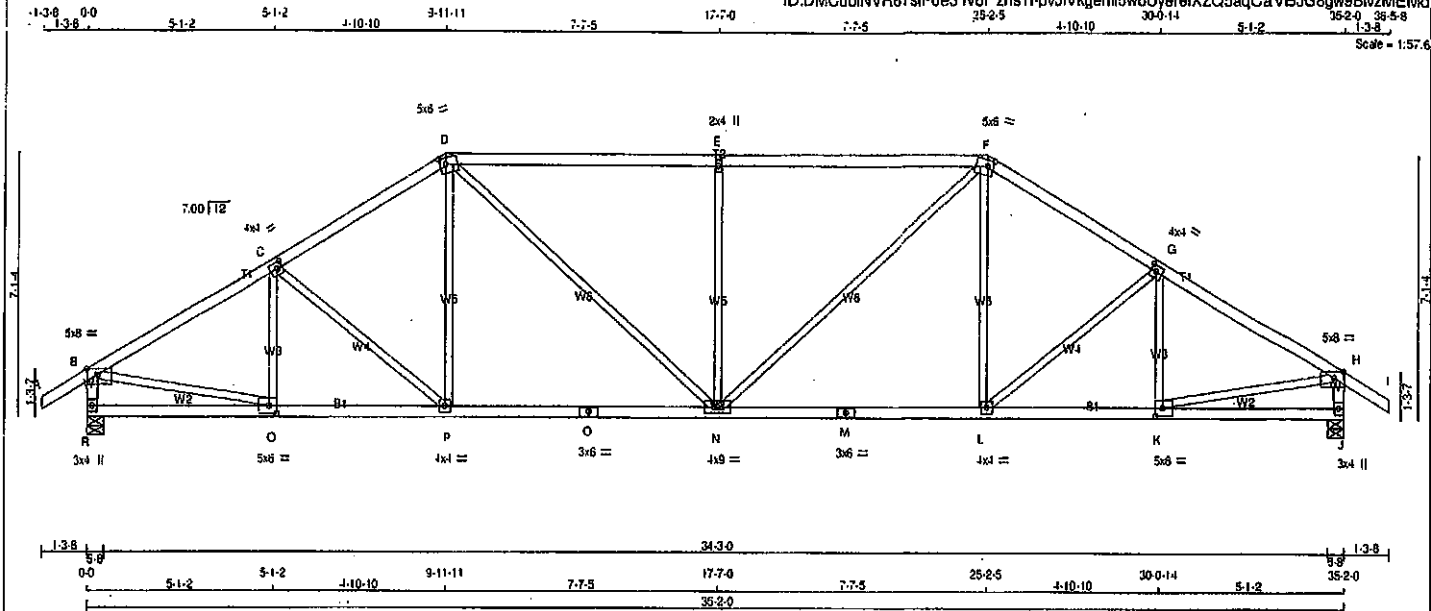

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	8.0	Edge 3.50
C	TMWV-i	MT20	4.0	4.0	2.00 1.75
D	TMWV-m	MT20	5.0	8.0	2.00 2.00
E	TMWV-w	MT20	2.0	4.0	
F	TMWV-m	MT20	5.0	8.0	2.00 2.00
G	TMWV-i	MT20	4.0	4.0	2.00 1.75
H	TMWV-p	MT20	5.0	8.0	Edge 3.50
J	BMV1-p	MT20	3.0	4.0	
K	BMWV-i	MT20	5.0	8.0	2.50 2.50
L	BMWV-i	MT20	4.0	4.0	
M	BS-i	MT20	3.0	8.0	
N	BMWVW-i	MT20	4.0	9.0	
O	BS-i	MT20	3.0	8.0	
P	BMWV-i	MT20	4.0	4.0	
Q	BMWV-i	MT20	5.0	8.0	2.50 2.50
R	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	HORZ	GROSS REACTION	GROSS REACTION	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
R	2084	0	2084	0	0	5-8	5-8	5-8	5-8
J	2084	0	2084	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL	DEAD	SOIL
R	1457	970.0	0.0	0.0	0.0	488.0	0.0	0.0	0.0
J	1457	970.0	0.0	0.0	0.0	488.0	0.0	0.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.16 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. UNBRACED LENGTH (FT)
FR-TO		FROM TO		FR-TO		FROM TO	
A-B	0 32	-91.8 -91.8 0.12 (1)	10.00	O-C	-335 0	0.09 (1)	
B-C	-2537 0	-91.8 -91.8 0.39 (1)	4.00	C-P	-216 0	0.16 (1)	
C-D	-2398 0	-91.8 -91.8 0.37 (1)	4.11	P-D	0 258	0.06 (4)	
D-E	-2609 0	-91.8 -91.8 0.88 (1)	3.16	D-N	0 752	0.17 (1)	
E-F	-2609 0	-91.8 -91.8 0.88 (1)	3.16	N-E	-880 0	0.75 (1)	
F-G	-2398 0	-91.8 -91.8 0.37 (1)	4.11	N-F	0 752	0.17 (1)	
G-H	-2537 0	-91.8 -91.8 0.39 (1)	4.00	L-F	0 258	0.06 (4)	
H-I	0 32	-91.8 -91.8 0.12 (1)	10.00	L-G	-216 0	0.16 (1)	
R-B	-2020 0	0.0 0.0 0.21 (1)	5.94	K-G	-335 0	0.09 (1)	
J-H	-2020 0	0.0 0.0 0.21 (1)	5.94	B-Q	0 2253	0.51 (1)	
R-Q	0 0	-18.5 -18.5 0.10 (4)	10.00	K-H	0 2253	0.51 (1)	
Q-P	0 2213	-18.5 -18.5 0.45 (1)	10.00				
P-O	0 2048	-18.5 -18.5 0.44 (1)	10.00				
O-N	0 2048	-18.5 -18.5 0.44 (1)	10.00				
N-M	0 2048	-18.5 -18.5 0.44 (1)	10.00				
M-L	0 2048	-18.5 -18.5 0.44 (1)	10.00				
L-K	0 2213	-18.5 -18.5 0.45 (1)	10.00				
K-J	0 0	-18.5 -18.5 0.10 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.137')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.27')

CSI: TC=0.88(1.00 (E-F:1), BC=0.45(1.00 (K-L:1), WS=0.75(1.00 (E-N:1), SS=0.34(1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	818 354	1687 788	1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (K) (INPUT = 0.90)
JSI METAL= 0.72 (M) (INPUT = 1.00)

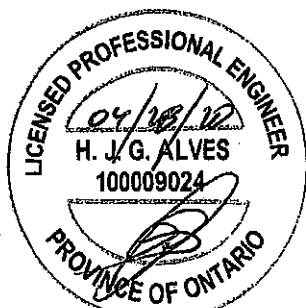

Structural component only
DWG# T-2007635

Structural component only
DWG# T-2007636


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T25	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTak Industries, Inc. Tue Apr 28 10:04:08 2020 Page 1

ID:DMCubINVR6TstFoe3tv6l zns1IHQVwQhuINMdm5oy3K?erAxP?FIIGSR7DelqozMEMb

Scale = 1:50.0

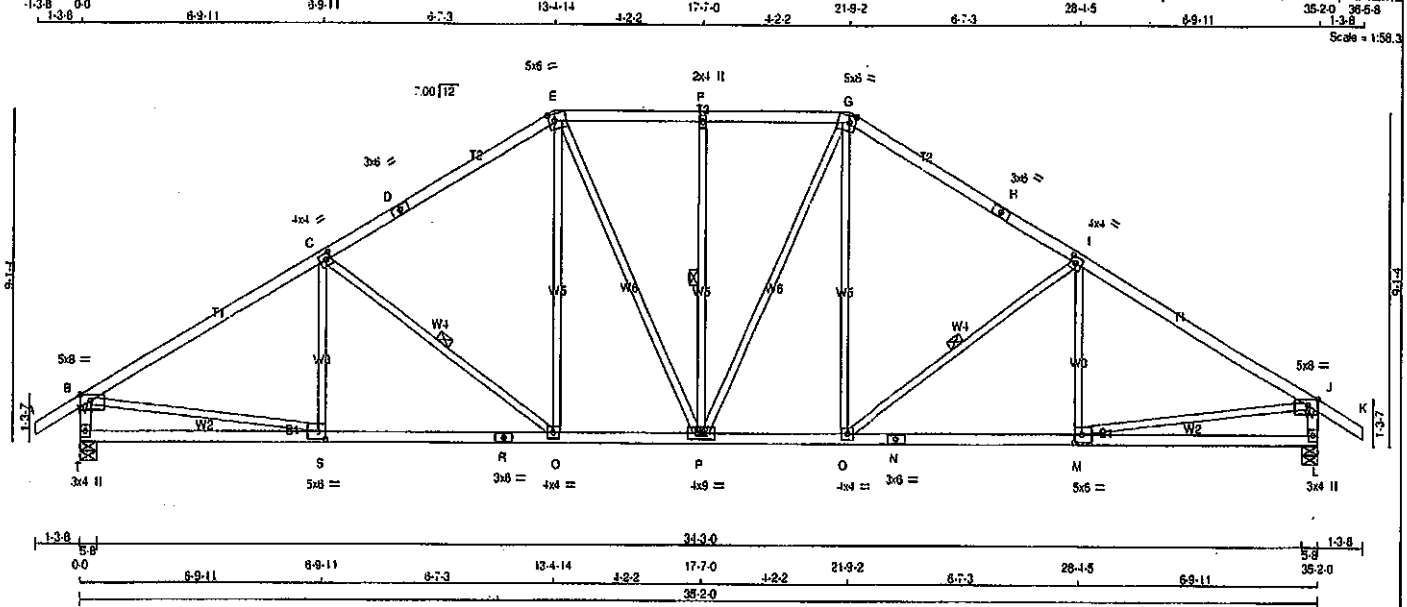

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
E - G	2x4	DRY	No.2
H - J	2x4	DRY	No.2
K - L	2x4	DRY	No.2
M - N	2x4	DRY	No.2
O - P	2x4	DRY	No.2
Q - R	2x4	DRY	No.2
S - T	2x4	DRY	No.2
U - V	2x4	DRY	No.2
W - X	2x4	DRY	No.2
Y - Z	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMWW-p	MT20	5.0	8.0	Edge	3.50
C TMWW-t	MT20	4.0	4.0	2.00	1.75
D TS-t	MT20	3.0	8.0		
E TTWW-m	MT20	5.0	8.0	2.25	2.00
F TMWW-w	MT20	2.0	4.0		
G TTWW-m	MT20	5.0	8.0	2.25	2.00
H TS-t	MT20	3.0	8.0		
I TMWW-t	MT20	4.0	4.0	2.00	1.75
J TMWW-p	MT20	5.0	8.0	Edge	3.50
L BMV1-p	MT20	3.0	4.0		
M BMWW-t	MT20	5.0	8.0	2.50	2.50
N BS-t	MT20	3.0	8.0		
O BMWW-t	MT20	4.0	4.0		
P BMWWW-t	MT20	4.0	4.0		
Q BMWW-t	MT20	4.0	4.0		
R BS-t	MT20	3.0	8.0		
S BMWW-t	MT20	5.0	8.0	2.50	2.50
T BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG	
T	2064	0	2064	0	5-8
L	2064	0	2064	0	5-8

UNFACTORED REACTIONS					
JT	1ST LCASE COMBINED	MAX MIN SNOW	MIN LIVE	PERM LIVE	WIND DEAD SOIL
T	1457	970	0	0	0
L	1457	970	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.54 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1:2 LENGTH OF C-Q, F-P, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING					
TOTAL LOAD CASES: (4)					

CHORDS					
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	WEBS
FR-TO					
A-B	0 32	-91.8	-91.8 0.12 (1)	10.00	S-C
B-C	-2590 0	-91.8	-91.8 0.74 (1)	3.54	C-Q
C-D	-2158 0	-91.8	-91.8 0.68 (1)	3.91	Q-E
D-E	-2158 0	-91.8	-91.8 0.88 (1)	3.91	E-P
E-F	-1958 0	-91.8	-91.8 0.24 (1)	4.61	P-F
F-G	-1958 0	-91.8	-91.8 0.24 (1)	4.61	P-G
G-H	-2158 0	-91.8	-91.8 0.68 (1)	3.91	O-G
H-I	-2158 0	-91.8	-91.8 0.68 (1)	3.91	O-I
I-J	-2590 0	-91.8	-91.8 0.74 (1)	3.54	M-I
J-K	0 32	-91.8	-91.8 0.12 (1)	10.00	B-S
T-B	-2011 0	0.0	0.0 0.20 (1)	5.95	M-J
L-J	-2011 0	0.0	0.0 0.20 (1)	5.95	
T-S	0 0	-18.5	-18.5 0.20 (4)	10.00	
S-R	0 2269	-18.5	-18.5 0.45 (1)	10.00	
R-Q	0 2269	-18.5	-18.5 0.45 (1)	10.00	
Q-P	0 1833	-18.5	-18.5 0.35 (1)	10.00	
P-O	0 1833	-18.5	-18.5 0.35 (1)	10.00	
O-N	0 2269	-18.5	-18.5 0.45 (1)	10.00	
N-M	0 2269	-18.5	-18.5 0.45 (1)	10.00	
M-L	0 0	-18.5	-18.5 0.20 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/CIG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CSI: TC=0.74/1.00 (I-J:1) . BC=0.45/1.00 (M-O:1) . WB=0.52/1.00 (J-M:1) . SS=0.26/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (S) INPUT = 0.80 1
JSI METAL= 0.69 (M) INPUT = 1.00 1




Structural component only
DWG# T-2007637

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T25A	3	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:09 2020 Page 1
ID:DMCubINVR6TsFoe31v8I zns11-DU u8m1W3gUUSxgCWmsEB3j6IPbOjwaMiOrMEzMEMa

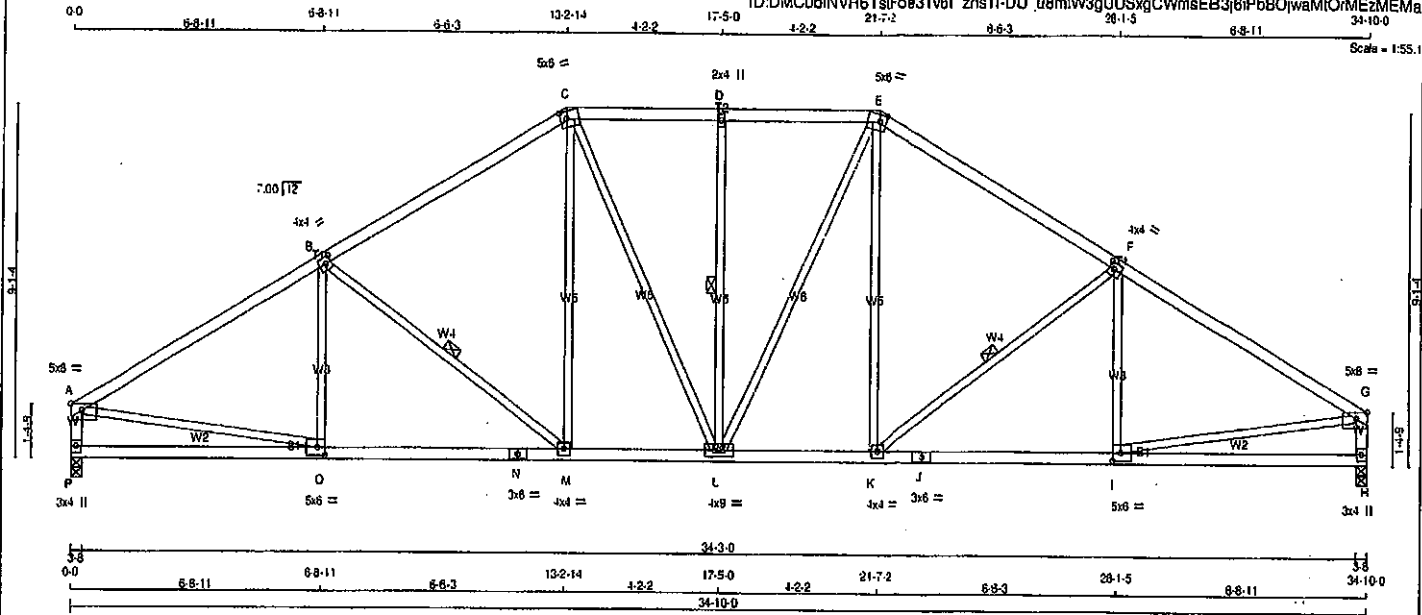

LUMBER			
N.L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS			
A - C	2x4	DRY	No.2
A - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
P - A	2x4	DRY	No.2
H - G	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW-p	MT20	5.0	8.0	2.00 Edge
B	TMVW-l	MT20	4.0	4.0	2.00 1.75
C	TTWW-m	MT20	5.0	8.0	2.25 2.00
D	TMVW-w	MT20	2.0	4.0	
E	TTWW-m	MT20	5.0	8.0	2.25 2.00
F	TMVW-l	MT20	4.0	4.0	2.00 1.75
G	TMVW-p	MT20	5.0	8.0	Edge 3.50
H	BMV-l	MT20	3.0	4.0	
I	BMVW-l	MT20	5.0	8.0	2.50 2.50
J	BS-l	MT20	3.0	6.0	
K	BMVW-l	MT20	4.0	4.0	
L	BMVW-l	MT20	4.0	9.0	
M	BMVW-l	MT20	4.0	4.0	
N	BS-l	MT20	3.0	6.0	
O	BMVW-l	MT20	5.0	8.0	2.50 2.50
P	BMV-l	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED	MAXIMUM FACTORED	INPUT	REQD	
	GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
P	1920	0	1920	0	3-8
H	1920	0	1920	0	3-8

UNFACTORED REACTIONS					
1ST LCASE	SNOW	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD
JT	COMBINED				
P	1358	891 0	0 0	0 0	467 0
H	1358	891 0	0 0	0 0	467 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.84 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF B-M, D-L, F-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	-2510 0	-91.8 -91.8 0.71 (1)	3.84	O-B	-212 40	0.09 (1)	
B-C	-2113 0	-91.8 -91.8 0.63 (1)	3.98	B-M	-510 0	0.24 (1)	
C-D	-1919 0	-91.8 -91.8 0.24 (1)	4.84	M-C	0 412	0.09 (1)	
D-E	-1919 0	-91.8 -91.8 0.24 (1)	4.84	C-L	0 287	0.06 (1)	
E-F	-2113 0	-91.8 -91.8 0.63 (1)	3.98	L-D	-461 0	0.25 (1)	
F-G	-2510 0	-91.8 -91.8 0.71 (1)	3.84	L-E	0 287	0.06 (1)	
P-A	-1868 0	0.0 0.0 0.19 (1)	6.13	K-E	0 412	0.09 (1)	
H-G	-1868 0	0.0 0.0 0.19 (1)	6.13	K-F	-510 0	0.24 (1)	
				I-F	-212 40	0.09 (1)	
P-O	0 0	-18.5 -18.5 0.20 (4)	10.00	A-O	0 2227	0.50 (1)	
O-N	0 2189	-18.5 -18.5 0.45 (1)	10.00	I-G	0 2227	0.50 (1)	
N-M	0 2189	-18.5 -18.5 0.45 (1)	10.00				
M-L	0 1797	-18.5 -18.5 0.35 (1)	10.00				
L-K	0 1797	-18.5 -18.5 0.35 (1)	10.00				
K-J	0 2189	-18.5 -18.5 0.45 (1)	10.00				
J-I	0 2189	-18.5 -18.5 0.45 (1)	10.00				
I-H	0 0	-18.5 -18.5 0.20 (4)	10.00				

TOTAL WEIGHT = 3 X 154 = 462 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOY CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

.55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.18")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.18")
CALCULATED VERT. DEFL.(TL) = L/999 (0.21")

CS1: TC=0.71 1.00 (A-B:1), BC=0.45 1.00 (M-O:1), WB=0.50 1.00 (A-O:1), SS1=0.26 1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (I) INPUT = 0.90
JSI METAL= 0.66 (N) INPUT = 1.00

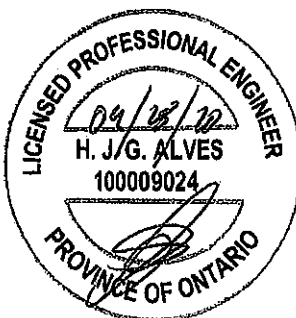

Structural component only
DWG# T-2007638

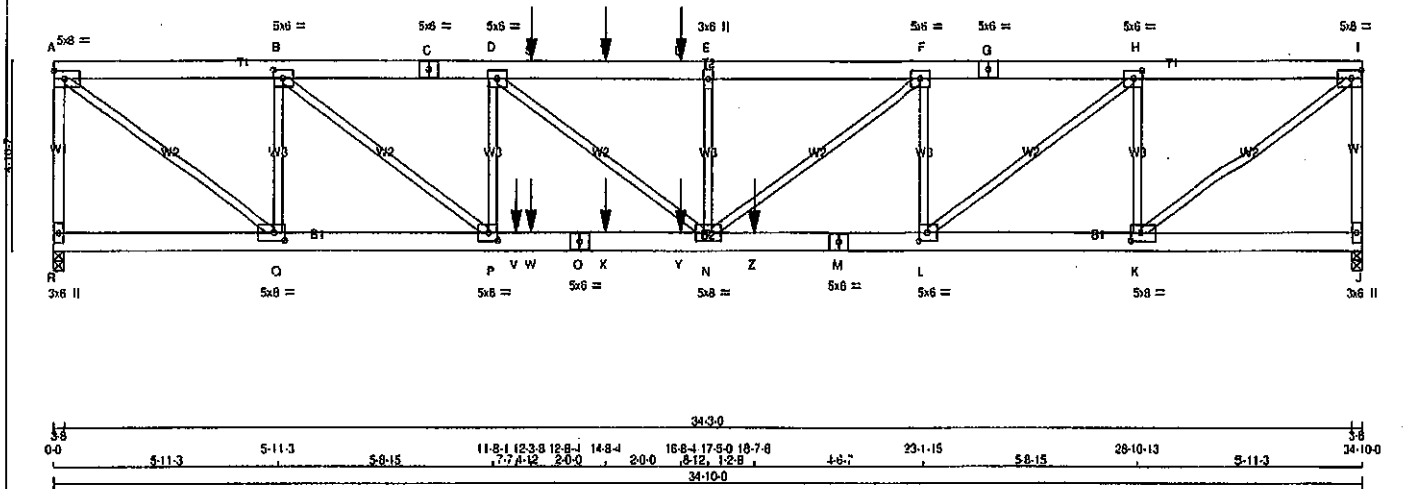

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
R - A	2x4	DRY	No.2	SPF
A - C	2x6	DRY	No.2	SPF
C - G	2x6	DRY	No.2	SPF
G - I	2x6	DRY	No.2	SPF
J - L	2x4	DRY	No.2	SPF
R - O	2x6	DRY	No.2	SPF
O - M	2x6	DRY	No.2	SPF
M - J	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
R - A 1	12	TOP
I - J 1	12	TOP
A - C 2	12	TOP
C - G 2	12	SIDE(0.01)
G - I 2	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
R - O 2	12	SIDE(0.01)
O - M 2	12	SIDE(0.01)
M - J 2	12	TOP
WEBS: (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORIZ	UPLIFT	IN-SX
R	3373	0	0	3-8
J	3103	0	0	3-8

UNFACTORED REACTIONS

	1ST CASE	MAX. MIN. COMPONENT REACTIONS	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW					
R	2380	1591	0	0	0	789	0
J	2190	1459	0	0	0	731	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.03 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR R310 CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM TO		FR-TO			
R-A	-3316	0.0	0.0 0.58 (1)	K-I	0	4719	0.58 (1)
A-B	-4149	-91.8	-91.8 0.14 (1)	A-Q	0	5171	0.64 (1)
B-C	-7288	-91.8	-91.8 0.20 (1)	K-H	-2757	0	0.44 (1)
C-D	-7288	-91.8	-91.8 0.20 (1)	Q-B	-2997	0	0.48 (1)
D-S	-8278	-91.8	-91.8 0.28 (1)	L-H	0	3530	0.44 (1)
S-T	-8278	-91.8	-91.8 0.28 (1)	B-P	0	3958	0.48 (1)
T-U	-8278	-91.8	-91.8 0.28 (1)	L-F	-1791	0	0.28 (1)
U-E	-8278	-91.8	-91.8 0.28 (1)	P-D	-1403	0	0.22 (1)
E-F	-8278	-91.8	-91.8 0.21 (1)	N-F	0	2134	0.26 (1)
F-G	-6586	-91.8	-91.8 0.19 (1)	D-N	0	1249	0.15 (1)
G-H	-6586	-91.8	-91.8 0.19 (1)	N-E	-873	0	0.11 (1)
H-I	-3787	-91.8	-91.8 0.13 (1)				
I-J	-3042	0.0	0.0 0.51 (1)				

R-Q	0 0	-18.5	-18.5	0.04 (4)	10.00
Q-P	0 4149	-18.5	-18.5	0.30 (1)	10.00
P-V	0 7288	-18.5	-18.5	0.67 (1)	10.00
V-W	0 7288	-18.5	-18.5	0.67 (1)	10.00
W-O	0 7288	-18.5	-18.5	0.67 (1)	10.00
O-X	0 7288	-18.5	-18.5	0.67 (1)	10.00
X-Y	0 7288	-18.5	-18.5	0.67 (1)	10.00
Y-N	0 7288	-18.5	-18.5	0.67 (1)	10.00
N-Z	0 6586	-18.5	-18.5	0.72 (1)	10.00
Z-M	0 6586	-18.5	-18.5	0.72 (1)	10.00
M-L	0 6586	-18.5	-18.5	0.72 (1)	10.00
L-K	0 3787	-18.5	-18.5	0.32 (1)	10.00
K-J	0 0	-18.5	-18.5	0.04 (4)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
S	12-8-4	-86	-86	---	BACK	VERT	TOTAL	---	C1
T	14-8-4	-86	-86	---	BACK	VERT	TOTAL	---	C1
U	16-8-4	-86	-86	---	BACK	VERT	TOTAL	---	C1
V	12-3-8	-1052	-1052	---	BACK	VERT	TOTAL	---	C1
W	12-8-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
X	14-8-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
Y	16-8-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
Z	18-7-8	-1273	-1273	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS
1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING # 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CSI: TC=0.58(1.00 (A-R:1), BC=0.72(1.00 (L-N:1), WB=0.64(1.00 (A-Q:1), SS=0.37(1.00 (L-N:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (I) (INPUT = 0.90)
JSI METAL = 0.73 (M) (INPUT = 1.00)



Structural component only
DWG# T-2007639 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T28	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:04:10 2020 Page 2


ID:DMCubINVR6TsIFoe3tv6I zns1HgYGL68g cL45FP4UNTkGGKlp777 kbX7PuhzMEMZ

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-I	MT20	5.0	8.0	2.50	3.25
B	TMVW-I	MT20	5.0	8.0	2.50	2.75
C	TS-I	MT20	5.0	8.0		
D	TMVW-I	MT20	5.0	8.0		
E	TMVW-I	MT20	5.0	8.0		
F	TMVW-I	MT20	5.0	8.0		
G	TS-I	MT20	5.0	8.0		
H	TMVW-I	MT20	5.0	8.0	2.50	2.75
I	TMVW-I	MT20	5.0	8.0	2.50	3.25
J	BMV1+p	MT20	3.0	8.0		
K	BMVW-I	MT20	5.0	8.0	2.50	3.25
L	BMVW-I	MT20	5.0	8.0	2.50	2.75
M	BS-I	MT20	5.0	8.0		
N	BMVW-I	MT20	5.0	8.0		
O	BS-I	MT20	5.0	8.0		
P	BMVW-I	MT20	5.0	8.0	2.50	2.75
Q	BMVW-I	MT20	5.0	8.0	2.50	3.25
R	BMV1+p	MT20	3.0	8.0		

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

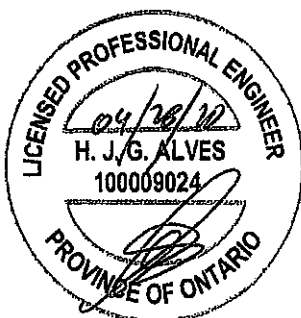


Structural component only
DWG# T-2007639 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T29	2	1	TRUSS DESC.		

Taharack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:04:11 2020 Page 1
ID:DMCubINVR6TstFoe31v6l zns1I-As6eYSkmbIkCfQbeBuiGUoUPDjseAlpBlyR7zMEMY
34-100
Scale = 1:54.8

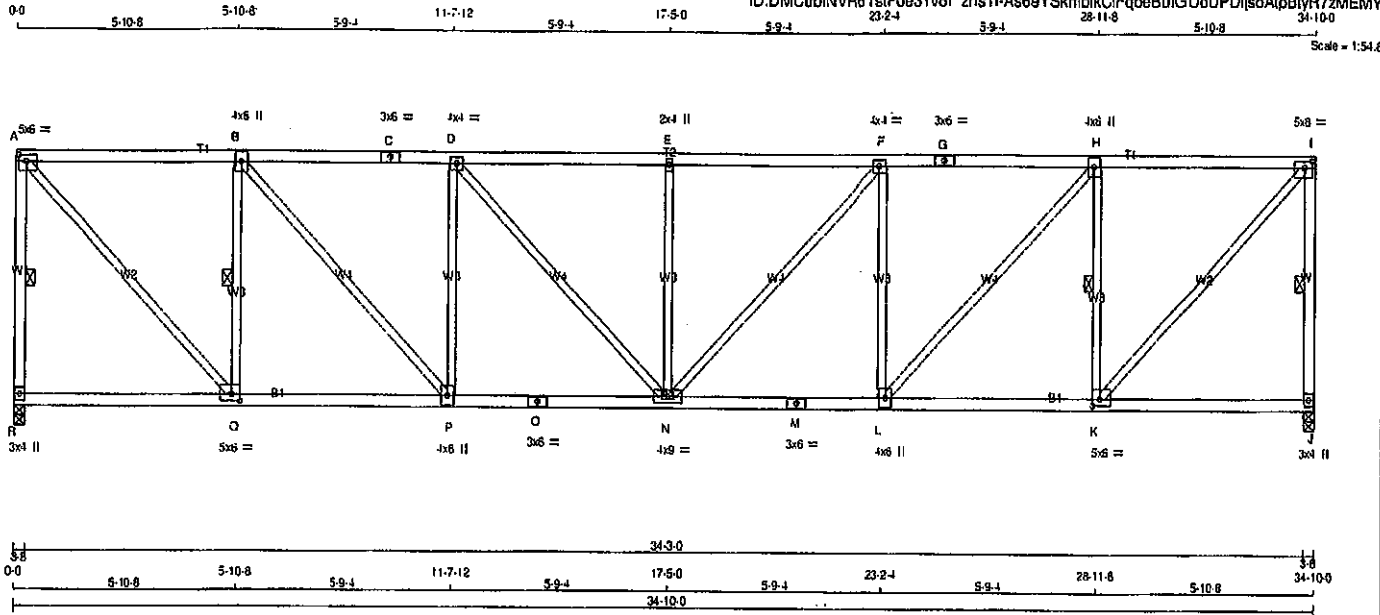

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
R - A	2x4 DRY	No.2	SPF		
A - C	2x4 DRY	No.2	SPF		
C - G	2x4 DRY	No.2	SPF		
G - I	2x4 DRY	No.2	SPF		
J - I	2x4 DRY	No.2	SPF		
R - O	2x4 DRY	No.2	SPF		
O - M	2x4 DRY	No.2	SPF		
M - J	2x4 DRY	No.2	SPF		
ALL WEBS	2x3 DRY	No.2	SPF		
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TMWV-I	MT20	5.0	6.0	2.00	2.50
B	TMWV-I	MT20	4.0	6.0		
C	TS-I	MT20	3.0	6.0		
D	TMWV-I	MT20	4.0	4.0		
E	TMWV-I	MT20	2.0	4.0		
F	TMWV-I	MT20	4.0	4.0		
G	TS-I	MT20	3.0	6.0		
H	TMWV-I	MT20	4.0	6.0		
I	TMWV-I	MT20	5.0	6.0	2.00	2.50
J	BMV-I	MT20	3.0	4.0		
K	BMWV-I	MT20	5.0	6.0	2.00	2.50
L	BMWV-I	MT20	4.0	6.0		
M	BS-I	MT20	3.0	6.0		
N	BMWV-I	MT20	4.0	9.0		
O	BS-I	MT20	3.0	6.0		
P	BMWV-I	MT20	4.0	6.0		
Q	BMWV-I	MT20	5.0	6.0	2.00	2.50
R	BMV-I	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HOZ	DOWN	HOZ
R	1920	0	1920	0
J	1920	0	1920	0

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED						
R	1358	891	0	0	0	467	0
J	1358	891	0	0	0	467	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-R, I-J, B-Q, H-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX CS1 (LC1)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC1)
FR-TO		FROM TO		LENGTH	FR-TO		
R-A	-1876 0	0.0 0.0	0.37 (1)	4.90	A-Q	0 2281	0.51 (1)
A-B	-1583 0	-81.8 -91.8	0.53 (1)	4.61	Q-B	-1540 0	0.43 (1)
B-C	-2426 0	-81.8 -91.8	0.63 (1)	3.77	B-P	0 1272	0.29 (1)
C-D	-2426 0	-81.8 -91.8	0.63 (1)	3.77	P-D	-831 0	0.58 (1)
D-E	-2725 0	-81.8 -91.8	0.58 (1)	3.72	D-N	0 440	0.10 (1)
E-F	-2725 0	-81.8 -91.8	0.58 (1)	3.72	N-E	-539 0	0.38 (1)
F-G	-2426 0	-81.8 -91.8	0.63 (1)	3.77	E-F	0 440	0.10 (1)
G-H	-2426 0	-81.8 -91.8	0.63 (1)	3.77	F-G	-831 0	0.59 (1)
H-I	-1583 0	-81.8 -91.8	0.53 (1)	4.61	I-H	0 1272	0.29 (1)
I-J	-1876 0	0.0 0.0	0.37 (1)	4.90	K-I	-1540 0	0.43 (1)
					K-I	0 2281	0.51 (1)
R-Q	0 0	-18.5 -18.5	0.15 (4)	10.00			
Q-P	0 1583	-18.5 -18.5	0.33 (1)	10.00			
P-O	0 2426	-18.5 -18.5	0.44 (1)	10.00			
O-N	0 2426	-18.5 -18.5	0.44 (1)	10.00			
N-M	0 2426	-18.5 -18.5	0.44 (1)	10.00			
M-L	0 2426	-18.5 -18.5	0.44 (1)	10.00			
L-K	0 1583	-18.5 -18.5	0.33 (1)	10.00			
K-J	0 0	-18.5 -18.5	0.15 (4)	10.00			

TOTAL WEIGHT = 2 X 157 = 314 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD			=	39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.18")
CALCULATED VERT. DEFL.(LL) = L/999 (0.18")
ALLOWABLE DEFL.(TL) = L/360 (1.18")
CALCULATED VERT. DEFL.(TL) = L/999 (0.31")

CS1: TC=0.63:1.00 (F-H:1), BC=0.44:1.00 (N-P:1), WB=0.58:1.00 (F-L:1), SS1=0.25:1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.87 (A) (INPUT = 0.90)
JSI METAL= 0.76 (M) (INPUT = 1.00)



Structural component only
DWG# T-2007640

JOB NAME 408223	TRUSS NAME T30	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:12 2020 Page 1
 ID:DMCubINVR6TstFoe31v6l_zns1l-e3p0mokOMbs3JPPnBvPxpHb5cdJb7s02rcVzZMEMX
 20-10-9 8-11-2 8-11-2 27-9-10 7-0-6 34-10-0
 Scale = 1:55.0

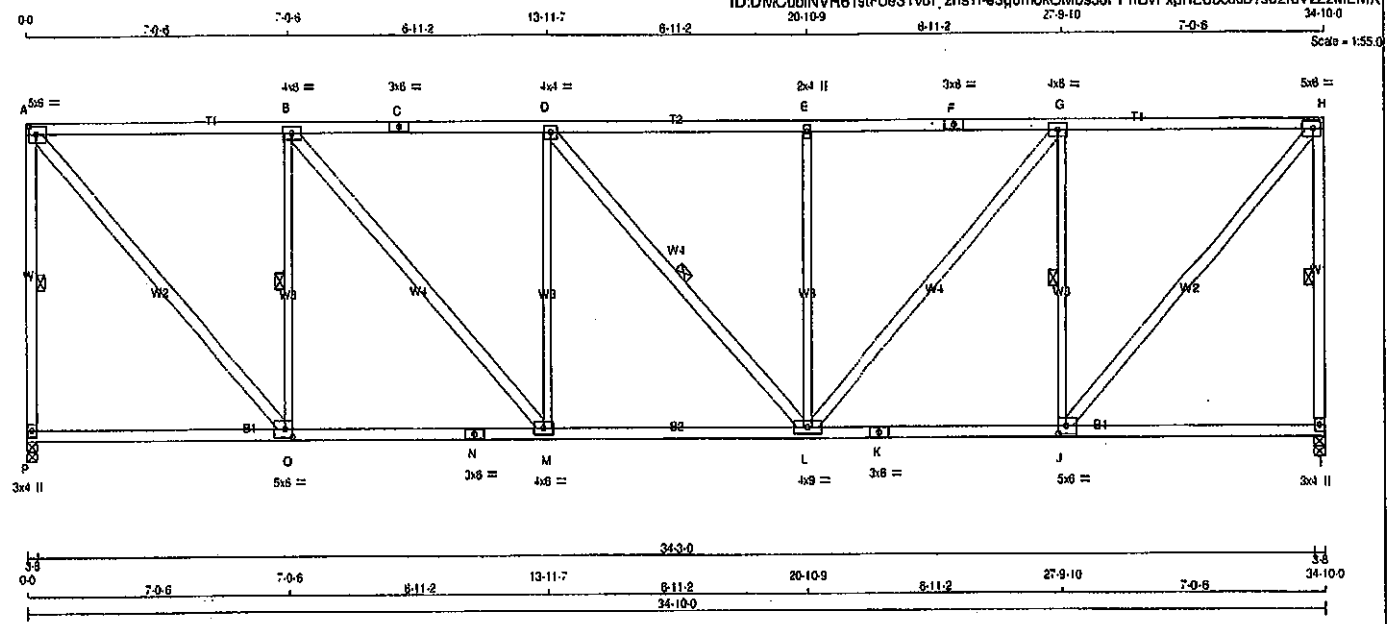

TOTAL WEIGHT = 2 X 179 = 359 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
P - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
I - H	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
ALL WEBS 2x4 DRY No.2			
EXCEPT			
O - B	2x3	DRY	No.2
M - D	2x3	DRY	No.2
L - E	2x3	DRY	No.2
J - G	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (Table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMVW-1	MT20	5.0	6.0 2.50 2.50
B	TMVW-1	MT20	4.0	6.0
C	TS-1	MT20	3.0	6.0
D	TMVW-1	MT20	4.0	4.0
E	TMVW-1	MT20	2.0	4.0
F	TS-1	MT20	3.0	6.0
G	TMVW-1	MT20	4.0	6.0
H	TMVW-1	MT20	5.0	6.0 2.50 2.50
I	BMV1+p	MT20	3.0	4.0
J	BMVW-1	MT20	5.0	6.0 2.50 2.50
K	BS-1	MT20	3.0	6.0
L	BMVW-1	MT20	4.0	6.0
M	BMVW-1	MT20	4.0	6.0
N	BS-1	MT20	3.0	6.0
O	BMVW-1	MT20	5.0	6.0 2.50 2.50
P	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
FACTORED				MAXIMUM FACTORED			
GROSS REACTION				GROSS REACTION			
JT	VERT	HORZ	DOWN	JT	VERT	HORZ	DOWN
P	1920	0	1920	0	0	0	0
I	1920	0	1920	0	0	0	0

UNFACTORED REACTIONS							
1ST CASE				MAX. MIN. COMPONENT REACTIONS			
JT	COMBINED	SNOW	LIVE	JT	COMBINED	SNOW	LIVE
P	1358	891	0	P	1358	891	0
I	1358	891	0	I	1358	891	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.60 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
 ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-P, H-I, B-O, D-L, G-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (LBS)	MAX. FACTORED (PLF)	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (LBS)	MAX. FACTORED (PLF)
FR-TO				FR-TO			
P-A	-1868	0	0.0	A-O	0	2158	0.35 (1)
A-B	-1432	0	-91.8	O-B	-1466	0	0.62 (1)
B-C	-2081	0	-91.8	B-M	0	986	0.18 (1)
C-D	-2081	0	-91.8	M-D	-517	0	0.81 (1)
D-E	-2080	0	-91.8	D-L	-2	0	0.00 (1)
E-F	-2080	0	-91.8	L-E	-618	0	0.81 (1)
F-G	-2080	0	-91.8	G-L	0	984	0.18 (1)
G-H	-1432	0	-91.8	L-G	-1465	0	0.62 (1)
H-I	-1868	0	0.0	I-H	0	2158	0.35 (1)
P-O	0	0	-18.5	O-N	0	1432	-18.5
O-N	0	1432	-18.5	N-M	0	1432	-18.5
N-M	0	1432	-18.5	M-L	0	2081	-18.5
M-L	0	2081	-18.5	L-K	0	1432	-18.5
L-K	0	1432	-18.5	K-J	0	1432	-18.5
K-J	0	1432	-18.5	J-I	0	0	-18.5
J-I	0	0	-18.5				

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/G

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
 ALLOWABLE DEFL.(TL) = L/360 (1.16")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.89/1.00 (E-G:1), BC=0.42/1.00 (L-M:1), WB=0.61/1.00 (D-M:1), SS=0.30/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 L5 BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MT20	618	354	1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (H) (INPUT = 0.90)
 JSI METAL= 0.46 (K) (INPUT = 1.00)




Structural component only
 DWG# T-2007641

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T31	5	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MATEK Industries, Inc. Tue Apr 28 10:04:14 2020 Page 1

ID:DMCubINVR6Ts(Foe31v6l_zns1l-aRomBTmhuD6nZlZAJKRPu6QxnQKq3sxJV95c1SzMEMV

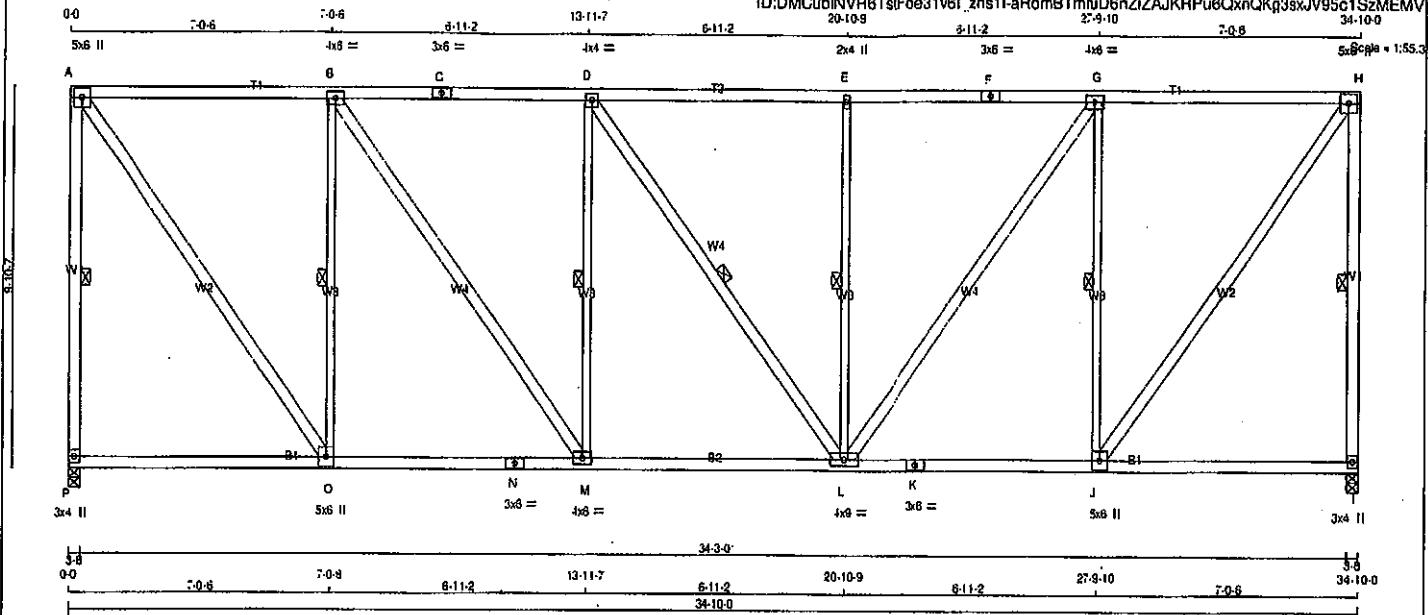

TOTAL WEIGHT = 5 X 196 = 981 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
P - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
I - H	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
ALL WEBS	2x4	DRY	No.2
EXCEPT			
O - B	2x3	DRY	No.2
M - D	2x3	DRY	No.2
L - E	2x3	DRY	No.2
J - G	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
A TMVW+p	MT20	5.0	6.0	
B TMVW-I	MT20	4.0	6.0	
C TS-I	MT20	3.0	6.0	
D TMVW-I	MT20	4.0	4.0	
E TMVW-w	MT20	2.0	4.0	
F TS-I	MT20	3.0	6.0	
G TMVW-I	MT20	4.0	6.0	
H TMVW+p	MT20	5.0	6.0	
I BMV-I+p	MT20	3.0	4.0	
J BMVW-I	MT20	5.0	6.0	
K BS-I	MT20	3.0	6.0	
L BMVW-w	MT20	4.0	9.0	
M BMVW-I	MT20	4.0	6.0	
N BS-I	MT20	3.0	6.0	
O BMVW-I	MT20	5.0	6.0	
P BMV-I+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	HORZ	BRG	IN-SX	BRG
P	1920	0	0	1920	0	0	3-8	3-8	3-8
I	1920	0	0	1920	0	0	3-8	3-8	3-8

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
P	1358	891 0	0 0	0 0	0 0	487 0	0 0
I	1358	891 0	0 0	0 0	0 0	487 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.98 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-P, H-I, B-O, D-M, D-L, E-L, G-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO		LENGTH	FR-TO		
P-A	-1868 0	0.0 0.0	0.88 (1)	4.91	A-O	0 1999	0.32 (1)
A-B	-1183 0	-91.8 -91.8	0.75 (1)	4.69	O-B	-1466 0	0.96 (1)
B-C	-1719 0	-91.8 -91.8	0.82 (1)	3.98	B-M	0 916	0.15 (1)
C-D	-1719 0	-91.8 -91.8	0.82 (1)	3.98	M-D	-817 0	0.41 (1)
D-E	-1718 0	-91.8 -91.8	0.83 (1)	4.37	D-L	-2 0	0.00 (1)
E-F	-1718 0	-91.8 -91.8	0.83 (1)	3.96	L-E	-816 0	0.41 (1)
F-G	-1718 0	-91.8 -91.8	0.83 (1)	3.96	L-G	0 913	0.15 (1)
G-H	-1183 0	-91.8 -91.8	0.75 (1)	4.69	J-G	-1465 0	0.96 (1)
H-I	-1868 0	0.0 0.0	0.88 (1)	4.91	J-H	0 2009	0.32 (1)
P-O	0 0	-18.5 -18.5	0.22 (4)	10.00			
O-N	0 1183	-18.5 -18.5	0.32 (4)	10.00			
N-M	0 1183	-18.5 -18.5	0.32 (4)	10.00			
M-L	0 1719	-18.5 -18.5	0.36 (1)	10.00			
L-K	0 1183	-18.5 -18.5	0.32 (4)	10.00			
K-J	0 1183	-18.5 -18.5	0.32 (4)	10.00			
J-I	0 0	-18.5 -18.5	0.22 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
OL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CS1: TC=0.88/1.00 (H-I), BC=0.36/1.00 (L-M), WB=0.96/1.00 (B-O), SS1=0.30/1.00 (G-H)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (H) (INPUT = 0.90)
JSI METAL = 0.43 (H) (INPUT = 1.00)

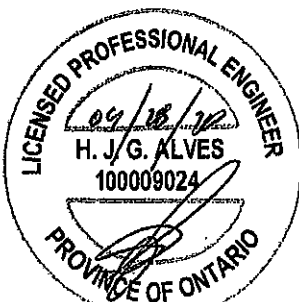

Structural component only
DWG# T-2007642

JOB NAME 408223	TRUSS NAME T32	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

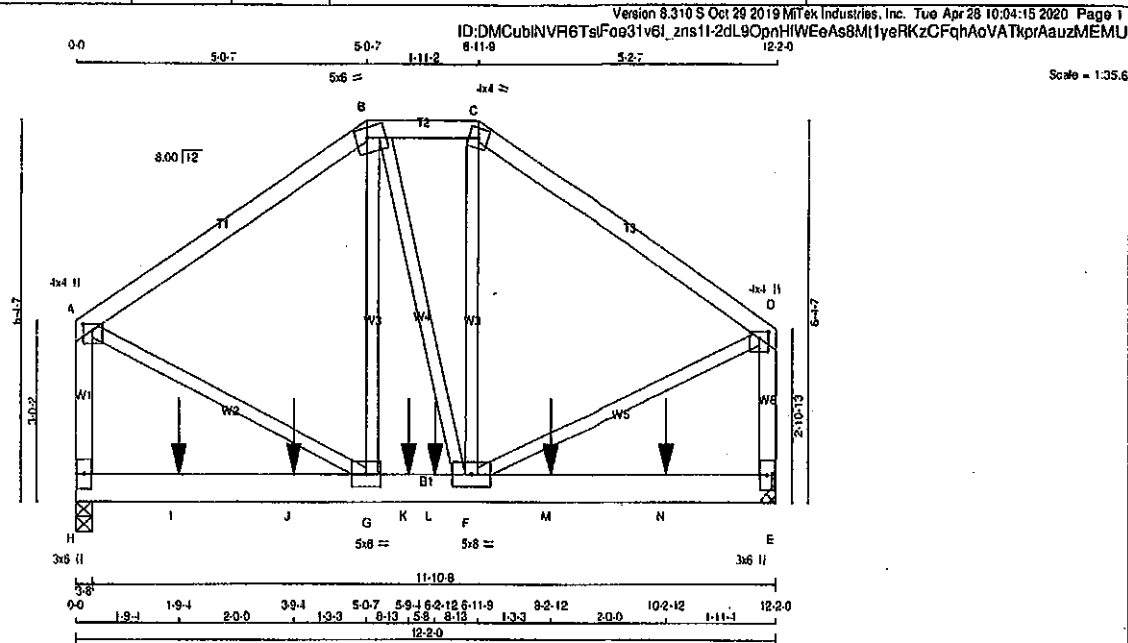


LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
H - A	2x4	DRY	No.2
E - D	2x4	DRY	No.2
H - E	2x6	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TTWW-m	MT20	5.0	6.0	2.00	2.25
C	TTWW-m	MT20	4.0	4.0		
D	TMVW+p	MT20	4.0	4.0	1.25	2.00
F	BMV1+p	MT20	3.0	6.0		
G	BMVW-W-1	MT20	5.0	6.0		
H	BMV1+p	MT20	3.0	6.0		

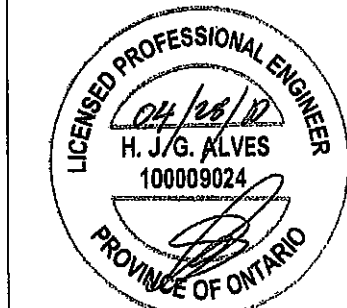

Structural component only
DWG# T-2007643

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
H	1233	0	1233	0
E	1218	0	1218	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	867	598	0	0	0	271	0
E	858	593	0	0	0	268	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)	
FR-TO		FROM TO		FR-TO			
A-B	-853	0	-81.8 -91.8 0.48 (1)	5.88	G-B	0	122 0.03 (1)
B-C	-721	0	-81.8 -91.8 0.07 (1)	6.25	B-F	0	34 0.01 (1)
C-D	-864	0	-81.8 -91.8 0.51 (1)	5.77	F-C	0	154 0.04 (1)
H-A	-1085	0	0.0 0.0 0.17 (1)	7.60	A-G	0	795 0.20 (1)
E-D	-1057	0	0.0 0.0 0.18 (1)	7.63	F-D	0	794 0.20 (1)
H-I	0	0	-18.5 -18.5 0.20 (1)	10.00			
I-J	0	0	-18.5 -18.5 0.20 (1)	10.00			
J-G	0	0	-18.5 -18.5 0.20 (1)	10.00			
G-K	0	711	-18.5 -18.5 0.28 (1)	10.00			
K-L	0	711	-18.5 -18.5 0.28 (1)	10.00			
L-F	0	711	-18.5 -18.5 0.28 (1)	10.00			
F-M	0	0	-18.5 -18.5 0.20 (1)	10.00			
M-N	0	0	-18.5 -18.5 0.20 (1)	10.00			
N-E	0	0	-18.5 -18.5 0.20 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
I	1-9-4	-172	-172	---	BACK	VERT	TOTAL	---
J	3-9-4	-195	-195	---	BACK	VERT	TOTAL	---
K	5-9-4	-187	-187	---	BACK	VERT	TOTAL	---
L	8-2-12	-187	-187	---	BACK	VERT	TOTAL	---
M	8-2-12	-195	-195	---	BACK	VERT	TOTAL	---
N	10-2-12	-172	-172	---	BACK	VERT	TOTAL	---

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.41")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.41")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.51 1.00 (C-D:1), BC=0.28 1.00 (F-G:1)
WB=0.20 1.00 (A-G:1), SS=0.20 1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	818	354	1687 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.78 (D) (INPUT = 0.90)
JSI METAL = 0.23 (D) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T34S	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Tue Apr 26 10:04:16 2020 Page 1

ID:DMCubINVR6TsiFoe31v6l_zns1l-WqyXc9ovQqMVo0IZQkUtzXVSIE5FX7ycZTaj6KzMEMT

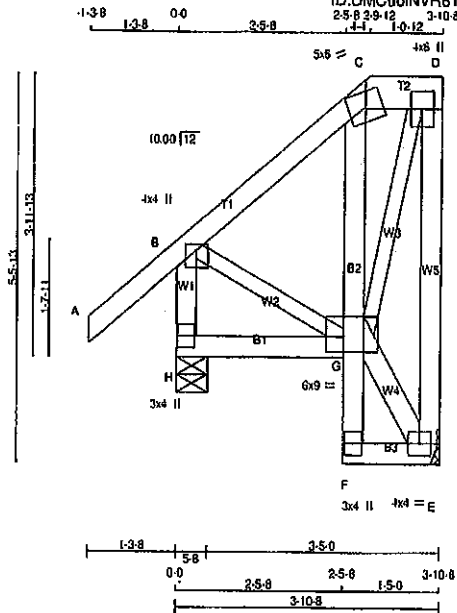

Scale = 1:30.1

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	No.2	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - D	2x6	DRY	No.2	SPF		
E - O	2x4	DRY	No.2	SPF		
H - B	2x4	DRY	No.2	SPF		
H - G	2x4	DRY	No.2	SPF		
F - C	2x4	DRY	No.2	SPF		
F - E	2x4	DRY	No.2	SPF		
ALL WEBS EXCEPT	2x4	DRY	No.2	SPF		
B - G	2x3	DRY	No.2	SPF		
G - D	2x3	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTV-m	MT20	5.0	6.0		
D	TMVW+p	MT20	4.0	6.0		
E	BMVW1-i	MT20	4.0	4.0		
F	BMV+p	MT20	3.0	4.0		
G	BVMWW4	MT20	6.0	9.0	2.50	3.00
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG.	BRG.
JT	VERT	HORZ	DOWN	UPLIFT
E	214	0	214	0
H	341	0	341	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	151	99.0	0.0	0.0	0.0	0.0	62.0	0.0
H	239	170.0	0.0	0.0	0.0	0.0	69.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0.41	-91.8 -91.8 0.14 (5)	G-E	-6.0 0.00 (11)
B-C	-82.0	-91.8 -91.8 0.12 (1)	B-G	0.53 0.01 (11)
C-D	-51.0	-91.8 -91.8 0.01 (1)	G-D	0.154 0.03 (11)
E-D	-197.0	0.0 0.0 0.10 (1)		
H-B	-317.0	0.0 0.0 0.03 (1)		
H-G	0.0	-18.5 -18.5 0.04 (4)		
F-G	0.13	0.0 0.0 0.01 (1)		
G-C	-138.0	0.0 0.0 0.01 (1)		
F-E	0.4	-18.5 -18.5 0.01 (4)		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./G.C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19')
CALCULATED VERT. DEFL.(LL) = L/999 (0.00')
ALLOWABLE DEFL.(TL) = L/360 (0.19')
CALCULATED VERT. DEFL.(TL) = L/999 (0.00')

CSI: TC=0.14:1.00 (A-B:5), BC=0.04:1.00 (G-H:4), WB=0.03:1.00 (D-G:1), SS=0.09:1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION	(PSI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1687	788	1987 1056


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (B) INPUT = 0.90
JSI METAL = 0.06 (B) INPUT = 1.00



Structural component only
DWG# T-2007644

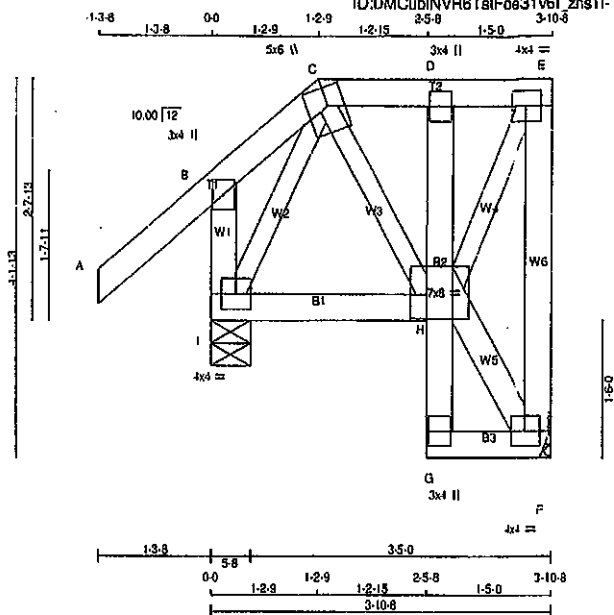

TOTAL WEIGHT = 2 X 29 = 57 lb

N.L.G.A. RULES				
CHORDS	SIZE		LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
F - E	2x4	DRY	No.2	SPF
I - B	2x4	DRY	No.2	SPF
I - H	2x4	DRY	No.2	SPF
G - D	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF

DRY; SEASONED LUMBER.

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TTWW+m	MT20	5.0	6.0	2.50	2.25
D	TMV+p	MT20	3.0	4.0		
E	TMVW-t	MT20	4.0	4.0		
F	BMVW1-t	MT20	4.0	4.0		
G	BMV+p	MT20	3.0	4.0		
H	BMVWWW-1	MT20	7.0	8.0	3.25	2.25
I	BMVW1-t	MT20	4.0	4.0		

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
F	191	0	191	0	0	MECHANICAL
I	383	0	383	0	0	5.8 5.8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

1ST CASE MAX. MIN. COMPONENT REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	135	86 13	0 0	0 0	0 0	49 0	0 0
I	254	183 0	0 0	0 0	0 0	72 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

LOADING
TOTAL LOAD CASES: (5)

CHORDS					WEBB				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	LC1 MAX (LBS)	LC1 MAX (LBS)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LBS)	FACTORED CS1 (LBS)
FR-TO		FROM	TO	CS1 (LBS)		FR-TO			
A-B	0 41	-91.8	-91.8	0.14 (5)	10.00	H-F	-6 0	0.00 (1)	
B-C	-45 0	-91.8	-91.8	0.14 (5)	8.25	H-E	0 141	0.00 (1)	
C-D	-69 0	-91.8	-91.8	0.02 (1)	8.25	C-H	0 48	0.01 (1)	
D-E	-87 0	-91.8	-91.8	0.02 (1)	8.25	I-C	-98 28	0.02 (1)	
F-E	-175 0	0.0	0.0	0.05 (1)	7.81				
I-B	-255 0	0.0	0.0	0.03 (1)	7.81				
I-H	-13 45	-18.5	-18.5	0.04 (4)	8.25				
G-H	0 13	0.0	0.0	0.01 (1)	11.00				
H-D	-135 0	0.0	0.0	0.01 (1)	7.81				
G-F	0 4	-18.5	-18.5	0.01 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOY CH.	LL	=	0.0	PSF
	OL	=	7.4	PSF
TOTAL LOAD			39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

DESIGN ASSUMPTIONS
OVERHANG NOT TO BE ALTERED OR CUT OFF

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF
LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.14/1.00 (A-B:5) , BC=0.04/1.00 (H-I:4) ,
WB=0.03/1.00 (E-H:1) , SSI=0.09/1.00 (A-B:5)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)	(PLI)	(PSI)	(PLI)	(PSI)	(PLI)
MT20	618	354	1667	788	1987	1856

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg

JSI GRIP= 0.18 (E) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007645

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T36	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:04:18 2020 Page 1					
ID:DMCubINVR6TstFoe31v6I zns11-TC1H0rp9yRcD1KexY9WL2ybo51j27vNvOn3q8DzMEMR					
Scale = 1:18.9					

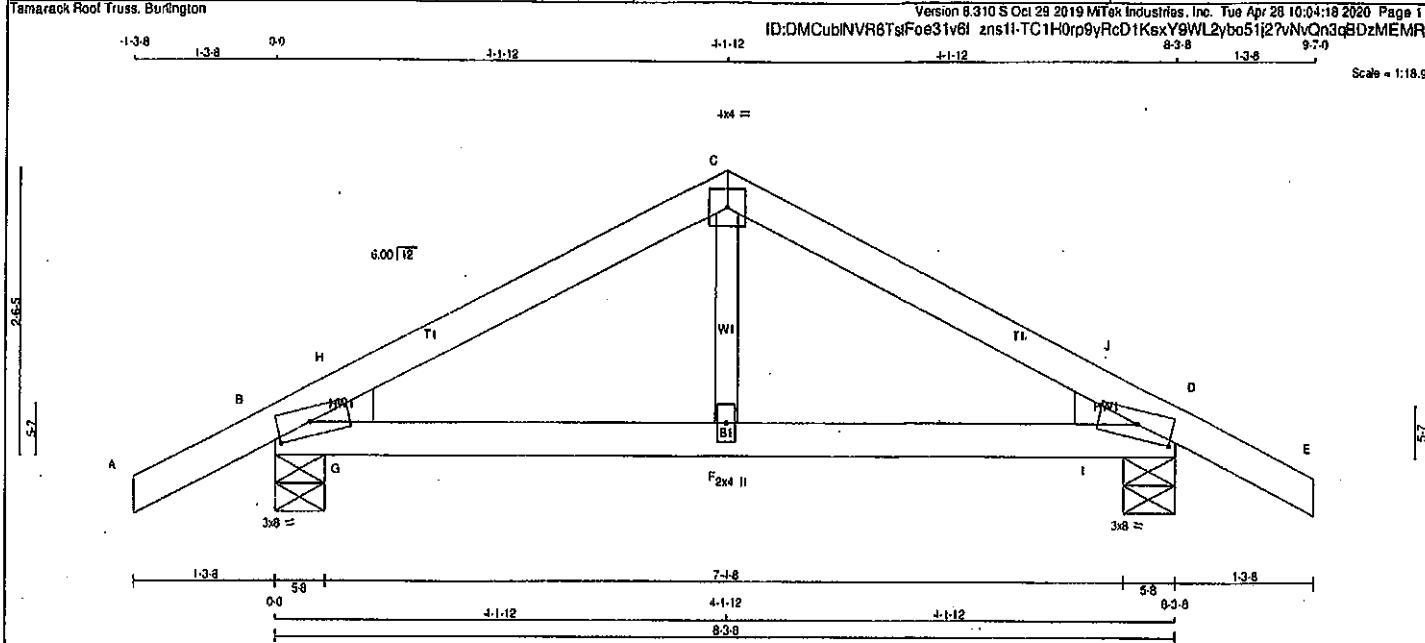

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
B - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (Table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMBH1-m	MT20	3.0	8.0	1.50 3.75
C	TTW-p	MT20	4.0	4.0	
D	TMBH1-m	MT20	3.0	8.0	1.50 3.75
F	BMW-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	HEEL
B	582	0	582	0	5-8
D	582	0	582	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX-MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	409	282	0	0	0	0	127	0
D	409	282	0	0	0	0	127	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: 14)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 23	-91.8 -91.8	0.12 (1)	10.00	F-C	0 170	0.04 (1)
B-H	-539 0	-91.8 -91.8	0.04 (1)	8.25	G-H	-158 3	0.00 (1)
H-C	-525 0	-91.8 -91.8	0.15 (1)	8.25	I-J	-158 3	0.00 (1)
C-J	-525 0	-91.8 -91.8	0.15 (1)	8.25			
J-D	-539 0	-91.8 -91.8	0.04 (1)	8.25			
D-E	0 23	-91.8 -91.8	0.12 (1)	10.00			
B-G	0 465	-18.5 -18.5	0.21 (1)	10.00			
G-F	0 465	-18.5 -18.5	0.21 (1)	10.00			
F-I	0 465	-18.5 -18.5	0.21 (1)	10.00			
I-O	0 465	-18.5 -18.5	0.21 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	8.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.28")

CALCULATED VERT. DEFL.(LL) = L/999 (0.01")

ALLOWABLE DEFL.(TL) = L/360 (0.28")

CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CS1: TC=0.15(1.00)(C-J:1), BC=0.21(1.00)(F-I:1),

WB=0.04(1.00)(C-F:1), SS=0.12(1.00)(C-J:1)

DOL LUMBER=1.00 NAL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.25 (8) (INPUT = 0.90)
JSI METAL = 0.11 (8) (INPUT = 1.00)

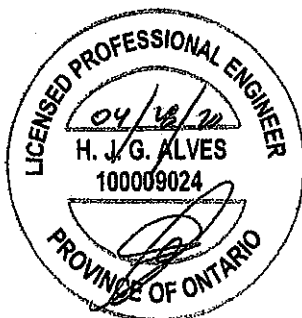

Structural component only
DWG# T-2007646

JOB NAME 408223	TRUSS NAME G36	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 26 10:03:49 2020 Page 1 ID:DMCubINVR8TslFoe31v6l_zns11-pdnKxwTznXyK3l8MLaVXNnrubLi5ioKemmYnIzMEMu

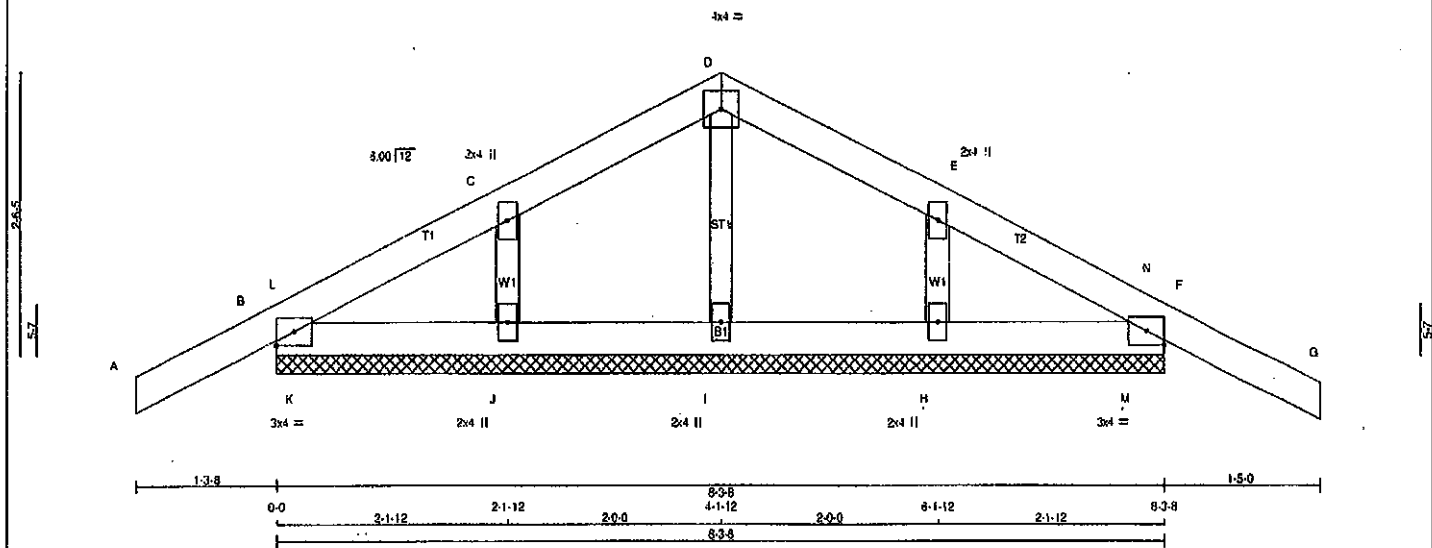

LUMBER			
N.L.G.A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
B - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMB1-I	MT20	3.0	4.0		Edge
C TMW+w	MT20	2.0	4.0		
D TTW-p	MT20	4.0	4.0		
E TMW+w	MT20	2.0	4.0		
F TMB1-I	MT20	3.0	4.0		Edge
H, I, J					
H BMW1+w	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	FACTORED LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED LC1 (LC)	UNBRACED LENGTH FR-TO
FR-TO				FR-TO			
A-B	0 23	-91.8	-91.8 0.12 (1)	10.00	I-D	-115 0	0.02 (1)
B-L	-81 0	-91.8	-91.8 0.01 (4)	6.25	J-C	-218 0	0.03 (1)
L-C	-39 0	-91.8	-91.8 0.06 (1)	6.25	H-E	-218 0	0.03 (1)
C-D	-45 0	-91.8	-91.8 0.06 (1)	6.25	K-L	-52 7	0.00 (1)
D-E	-45 0	-91.8	-91.8 0.06 (1)	6.25	M-N	-52 7	0.00 (1)
E-N	-39 0	-91.8	-91.8 0.06 (1)	6.25			
N-F	-61 0	-91.8	-91.8 0.01 (4)	6.25			
F-G	0 25	-91.8	-91.8 0.14 (1)	10.00			
B-K	0 44	-18.5	-18.5 0.03 (1)	10.00			
K-J	0 44	-18.5	-18.5 0.03 (1)	10.00			
J-I	0 32	-18.5	-18.5 0.02 (1)	10.00			
I-H	0 32	-18.5	-18.5 0.02 (1)	10.00			
H-M	0 44	-18.5	-18.5 0.03 (1)	10.00			
M-F	0 44	-18.5	-18.5 0.03 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.14/1.00 (F-G:1), BC=0.03/1.00 (H-M:1), WB=0.03/1.00 (E-H:1), SS=0.10/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)		SHEAR		SECTION	
(PSI)		(PLI)		(PLI)	
MAX	MIN	MAX	MIN	MAX	MIN
MT20	618 354	1667	788	1987	1858


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.21 (B) (INPUT = 0.90)
JSI METAL = 0.09 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007621

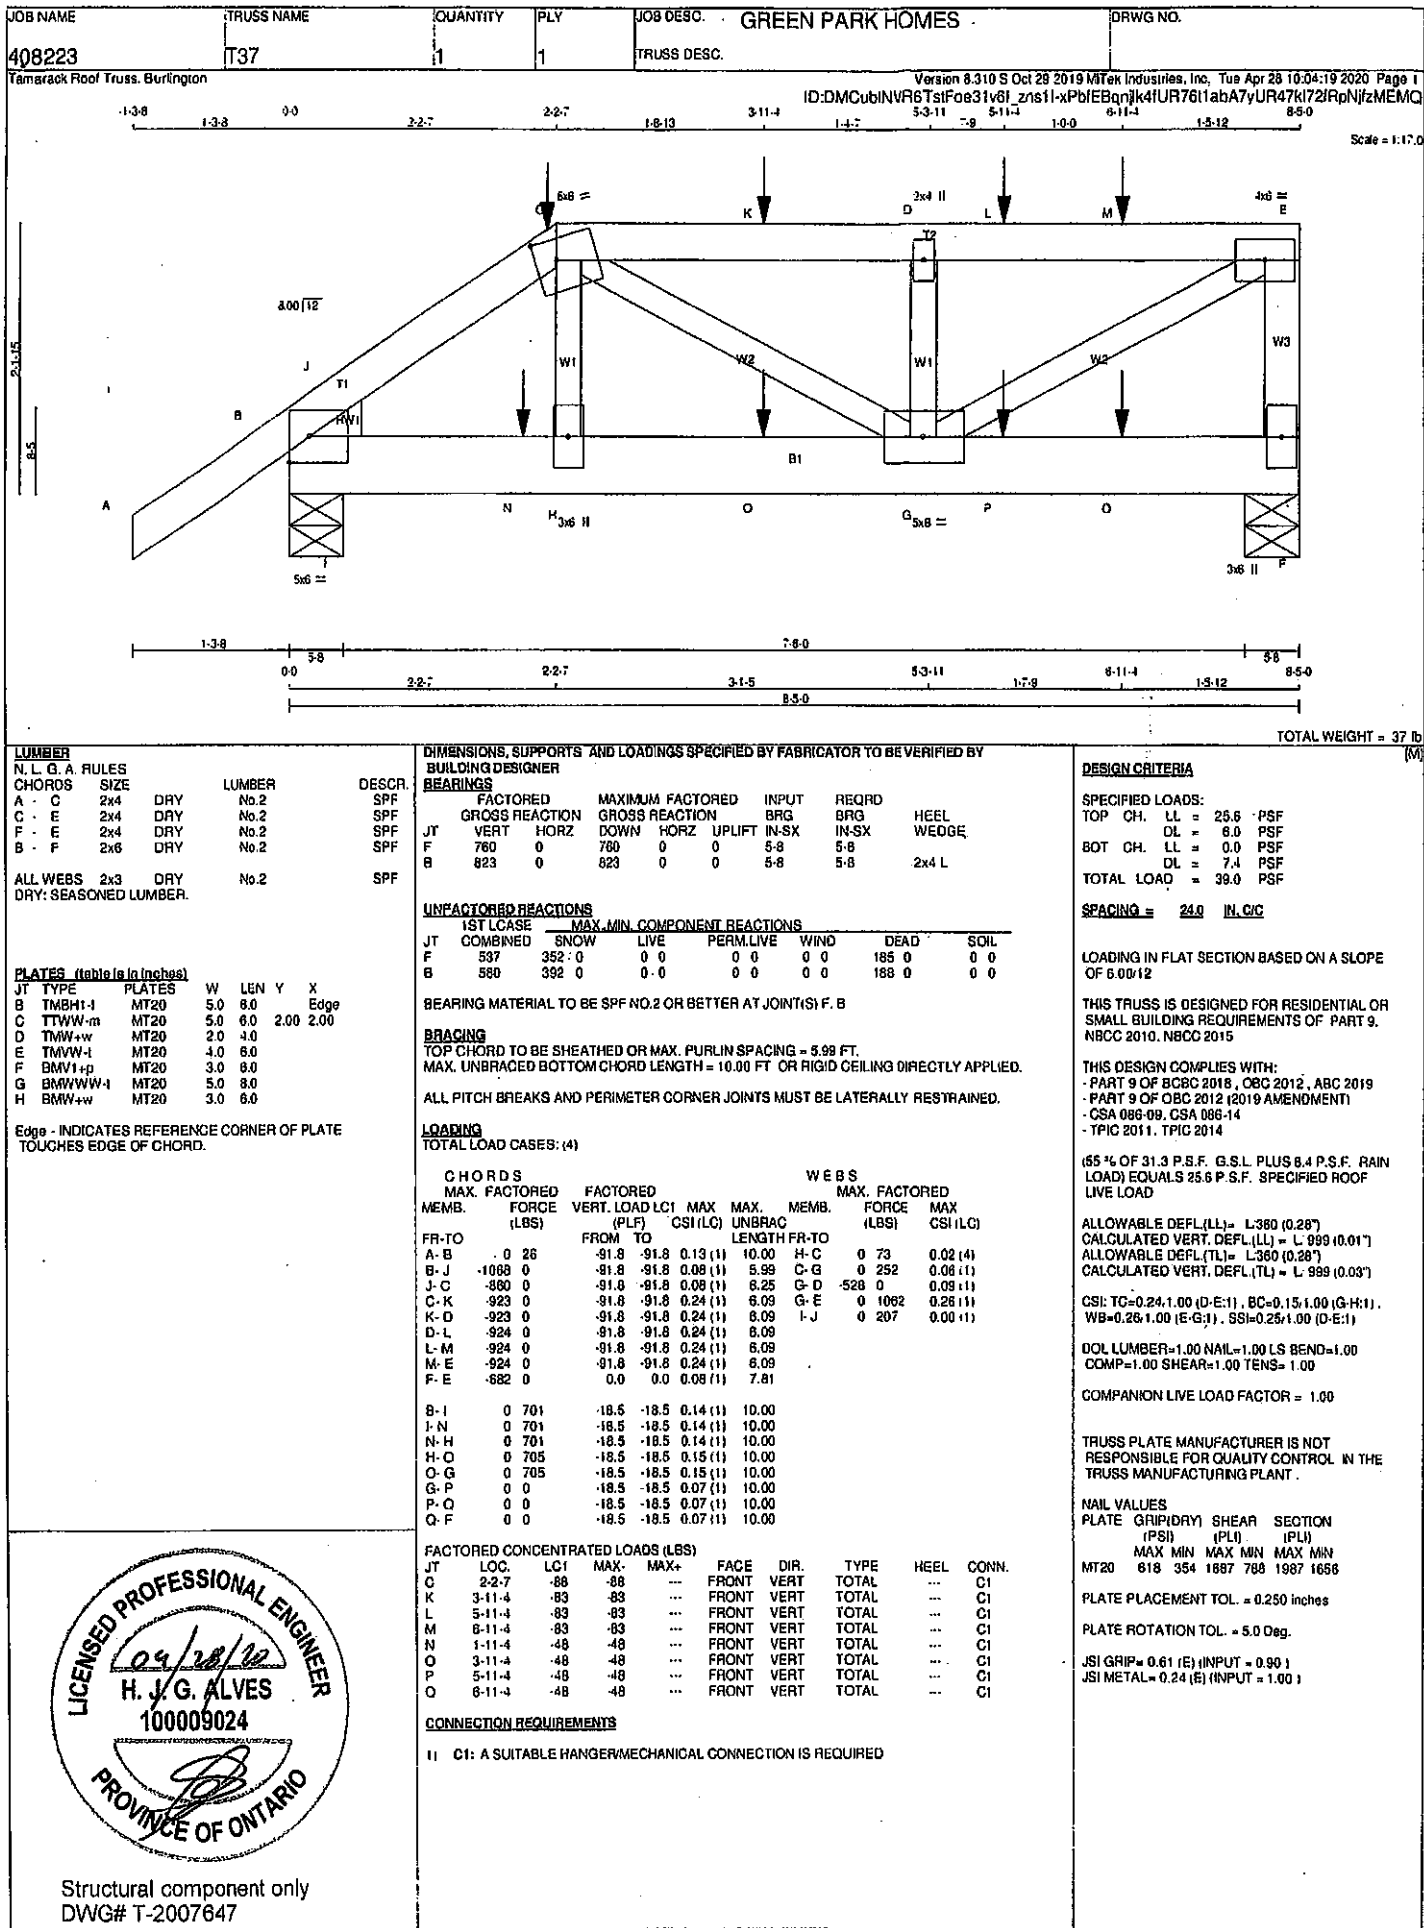

JOB NAME 408223	TRUSS NAME G39	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

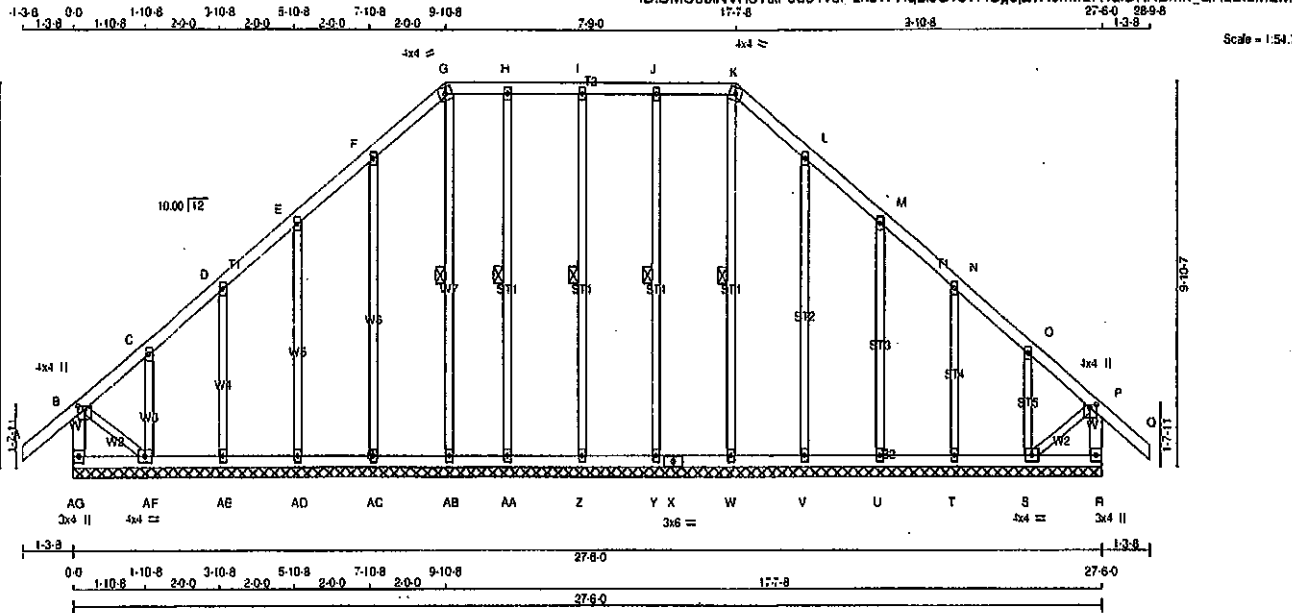


LUMBER N.L. G. A. RULES CHORDS SIZE LUMBER DESCR. SPF AG - B 2x4 DRY No.2 A - G 2x4 DRY No.2 G - K 2x4 DRY No.2 K - Q 2x4 DRY No.2 R - P 2x4 DRY No.2 AG - X 2x4 DRY No.2 X - R 2x4 DRY No.2 ALL WEBS 2x3 DRY No.2 SPF ALL GABLE WEBS 2x3 DRY No.2 SPF DRY: SEASONED LUMBER. GABLE STUDS SPACED AT 2-0-0 OC.				PLATES (table is in inches) JT TYPE PLATES W LEN Y X B TMW+p MT20 4.0 4.0 1.00 2.00 C, D, E, F, H, I, J, L, M, N, O C TMW+w MT20 2.0 4.0 G TTW-m MT20 4.0 4.0 K TTW-m MT20 4.0 4.0 P TMW+p MT20 4.0 4.0 1.00 2.00 R BMV1+p MT20 3.0 4.0 S BMWV1+ MT20 4.0 4.0 T, U, V, W, Y, Z, AA, AB, AC, AD, AE T BMW1+w MT20 2.0 4.0 K BS-1 MT20 3.0 5.0 AF BMWV1+ MT20 4.0 4.0 AG BMV1+p MT20 3.0 4.0				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 25.6 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.0:12 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF BCBC 2018, CBC 2012, ABC 2019 - PART 9 OF CBC 2012 (2019 AMENDMENT) - CSA 086-09, CSA 086-14 - TPIC 2011, TPIC 2014 DESIGN ASSUMPTIONS -OVERHANG NOT TO BE ALTERED OR CUT OFF. 155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD CSF: TC=0.13:1.00 (P-Q:1), BC=0.02:1.00 (S-T:4), WB=0.27:1.00 (L-V:1), SS=0.09:1.00 (J-K:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10 COMPANION LIVE LOAD FACTOR = 1.00 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (FLI) MAX MIN MAX MIN MAX MIN MT20 610 354 1887 788 1987 1658 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.62 (K) INPUT = 0.90 JSI METAL= 0.11 (L) INPUT = 1.00				CHORDS MAX. FACTORED FORCE (LBS) FACTORED VERT. LOAD (PLF) MAX UNBRACED LENGTH (L) FR-TO TO AG-B -282 0 0.0 0.0 0.03 (1) 7.81 A-B 0 41 -91.8 -91.8 0.13 (1) 10.00 B-C -60 0 -91.8 -91.8 0.12 (1) 6.25 C-D -23 0 -91.8 -91.8 0.05 (1) 6.25 D-E -26 0 -91.8 -91.8 0.05 (1) 6.25 E-F -19 0 -91.8 -91.8 0.05 (1) 6.25 F-G -29 0 -91.8 -91.8 0.05 (1) 6.25 G-H -12 0 -91.8 -91.8 0.04 (1) 6.25 H-I -12 0 -91.8 -91.8 0.04 (1) 6.25 I-J -12 0 -91.8 -91.8 0.05 (1) 6.25 J-K -12 0 -91.8 -91.8 0.05 (1) 6.25 K-L -30 0 -91.8 -91.8 0.05 (1) 6.25 L-M -19 0 -91.8 -91.8 0.05 (1) 6.25 M-N -26 0 -91.8 -91.8 0.05 (1) 6.25 N-O -24 0 -91.8 -91.8 0.05 (1) 6.25 O-P -60 0 -91.8 -91.8 0.12 (1) 6.25 P-Q 0 41 -91.8 -91.8 0.13 (1) 10.00 R-P -283 0 0.0 0.0 0.03 (1) 7.81 AG-AF 0 0 -18.5 -18.5 0.02 (4) 10.00 AF-AE 0 23 -18.5 -18.5 0.02 (4) 10.00 AE-AD 0 19 -18.5 -18.5 0.02 (4) 10.00 AD-AC 0 16 -18.5 -18.5 0.02 (4) 10.00 AC-AB 0 14 -18.5 -18.5 0.02 (4) 10.00 AB-AA 0 12 -18.5 -18.5 0.01 (4) 10.00 AA-Z 0 12 -18.5 -18.5 0.02 (4) 10.00 Z-Y 0 12 -18.5 -18.5 0.02 (4) 10.00 Y-X 0 12 -18.5 -18.5 0.02 (4) 10.00 X-W 0 12 -18.5 -18.5 0.02 (4) 10.00 W-V 0 14 -18.5 -18.5 0.02 (4) 10.00 V-U 0 16 -18.5 -18.5 0.02 (4) 10.00 U-T 0 19 -18.5 -18.5 0.02 (4) 10.00 T-S 0 23 -18.5 -18.5 0.02 (4) 10.00 S-R 0 0 -18.5 -18.5 0.02 (4) 10.00 WEBS MAX. FACTORED FORCE (LBS) MAX UNBRACED LENGTH (L) FR-TO TO W-K -140 0 0.09 (1) 0.09 (1) Y-J -210 0 0.14 (1) 0.14 (1) Z-I -181 0 0.12 (1) 0.12 (1) AA-H -182 0 0.12 (1) 0.12 (1) V-L -203 0 0.27 (1) 0.27 (1) U-M -175 0 0.13 (1) 0.13 (1) T-N -192 0 0.07 (1) 0.07 (1) S-O -126 0 0.02 (1) 0.02 (1) AB-G -121 0 0.08 (1) 0.08 (1) AC-F -202 0 0.27 (1) 0.27 (1) AD-E -176 0 0.13 (1) 0.13 (1) AE-D -192 0 0.07 (1) 0.07 (1) AF-C -126 0 0.02 (1) 0.02 (1) B-AF 0 32 0.01 (1) 0.01 (1) S-P 0 32 0.01 (1) 0.01 (1)			
--	--	--	--	---	--	--	--	--	--	--	--	---	--	--	--



Structural component only
DWG# T-2007622

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	T40	1	2	TRUSS DESC.		
Tamarack Roof Truss, Burlington						Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Tue Apr 28 10:19:57 2020 Page 1
ID:DMCubINVR6TsIFoe31v6l_zns1I-TsGG5wA9pyw_Bd8P2isXcz_APYAIVTa7LN10dlzME7m						35-20 36-5-8 1-3-8 1-3-8
Scale = 1:57.6						

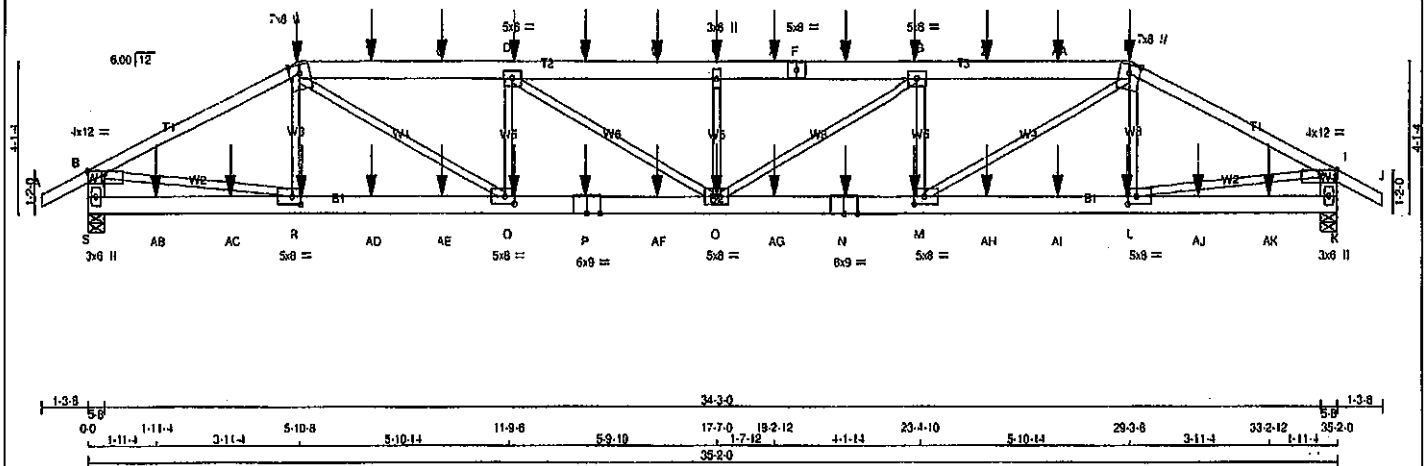

TOTAL WEIGHT = 2 X 169 = 338 lb [M]

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR
A - C	2x4	DRY	No.2	SPF	
C - F	2x6	DRY	No.2	SPF	
F - H	2x6	DRY	No.2	SPF	
H - J	2x4	DRY	No.2	SPF	
S - B	2x6	DRY	No.2	SPF	
K - I	2x6	DRY	No.2	SPF	
S - P	2x8	DRY	1850F 1.5E	SPF	
P - N	2x8	DRY	1850F 1.5E	SPF	
N - K	2x6	DRY	1850F 1.5E	SPF	
ALL EXCEPT	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C	12	SIDE(61.0)
H-J	12	SIDE(61.0)
C-F	12	SIDE(183.1)
F-H	12	SIDE(183.1)
S-B	12	TOP
K-I	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
S-P	12	SIDE(183.1)
P-N	12	SIDE(183.1)
N-K	12	SIDE(183.1)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
S	3323	0	0	5-8
K	3323	0	0	5-8

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW
S	2350	1539 0
K	2350	1539 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.87 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING	CHORDS	WEBS
TOTAL LOAD CASES: (4)		
	MAX. FACTORED	MAX. FACTORED
	MEMB. FORCE (LBS)	MEMB. FORCE (LBS)
	VERT. LOAD (PLF)	VERT. LOAD (PLF)
	MAX. FACTORED	MAX. FACTORED
	FROM TO	FROM TO
	FR-TO	FR-TO
	A-B	0 28
	B-C	-5068 0
	C-T	-7284 0
	T-U	-7284 0
	U-D	-7284 0
	D-V	-8084 0
	V-W	-8084 0
	W-E	-8084 0
	E-X	-8084 0
	X-F	-8084 0
	F-Y	-8084 0
	Y-G	-8084 0
	G-Z	-7284 0
	Z-AA	-7284 0
	AA-H	-7284 0
	H-I	-5068 0
	I-J	0 28
	J-S	-3248 0
	S-B	-3248 0
	B-K	-3248 0

SAB	0 0	-18.5	-18.5	0.04 (4)	10.00
AB-AC	0 0	-18.5	-18.5	0.04 (4)	10.00
AC-R	0 0	-18.5	-18.5	0.04 (4)	10.00
R-AD	0 4553	-18.5	-18.5	0.22 (1)	10.00
AD-AE	0 4553	-18.5	-18.5	0.22 (1)	10.00
AE-O	0 4553	-18.5	-18.5	0.22 (1)	10.00
O-P	0 7283	-18.5	-18.5	0.34 (1)	10.00
P-AF	0 7283	-18.5	-18.5	0.34 (1)	10.00
AF-O	0 7283	-18.5	-18.5	0.34 (1)	10.00
O-AG	0 7283	-18.5	-18.5	0.34 (1)	10.00
AG-N	0 7283	-18.5	-18.5	0.34 (1)	10.00
N-M	0 7283	-18.5	-18.5	0.34 (1)	10.00
M-AH	0 4553	-18.5	-18.5	0.22 (1)	10.00
AH-AI	0 4553	-18.5	-18.5	0.22 (1)	10.00
AI-L	0 4553	-18.5	-18.5	0.22 (1)	10.00
L-AJ	0 0	-18.5	-18.5	0.04 (4)	10.00
AJ-AK	0 0	-18.5	-18.5	0.04 (4)	10.00
AK-K	0 0	-18.5	-18.5	0.04 (4)	10.00

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-429	-429	---	FRONT	VERT	TOTAL	---	C1
D	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ORC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1/17)
CALCULATED VERT. DEFL. (LL) = L/999 (0.21")
ALLOWABLE DEFL. (TL) = L/360 (1/17)
CALCULATED VERT. DEFL. (TL) = L/999 (0.39")

CSI: TC=0.52/1.00 (B-C:1), BC=0.34/1.00 (O-Q:1), WB=0.57/1.00 (B-R:1), SS=0.15/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (R) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1067 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.56 (R) (INPUT = 0.90)
JSI METAL= 0.56 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007660 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T40	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				Version 8.310 5 Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:19:57 2020 Page 2	
				ID:DMCubINVR6TsFoe31v6I 2ns1I-TsGG5wA9pyw Bd8P2lsXcz APYAIVTa7LN10dzME7m	

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMWW-p	MT20	4.0	12.0	1.00 5.50
C	TTWW+m	MT20	7.0	8.0	Edge
D	TMWW-l	MT20	5.0	8.0	
E	TMWW-w	MT20	3.0	8.0	
F	TS-l	MT20	5.0	8.0	
G	TMWW-l	MT20	5.0	8.0	
H	TTWW+m	MT20	7.0	8.0	Edge
I	TMWW-p	MT20	4.0	12.0	1.00 5.50
K	BMV1-p	MT20	3.0	8.0	
L	BMWW-l	MT20	5.0	8.0	2.50 3.00
M	BMWW-l	MT20	5.0	8.0	2.50 3.25
N	BS-l	MT20	8.0	9.0	
O	BMWW-l	MT20	5.0	8.0	
P	BS-l	MT20	8.0	9.0	
Q	BMWW-l	MT20	5.0	8.0	2.50 3.25
R	BMWW-l	MT20	5.0	8.0	2.50 3.00
S	BMV1-p	MT20	3.0	8.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	17-7-0	-110	-110	---	FRONT	VERT	TOTAL	---	C1
G	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	29-3-8	-429	-429	---	FRONT	VERT	TOTAL	---	C1
L	29-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
M	23-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
N	21-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
O	17-7-0	-26	-26	---	FRONT	VERT	TOTAL	---	C1
P	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Q	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	19-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	21-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	1-11-4	-25	-26	---	FRONT	VERT	TOTAL	---	C1
AC	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AD	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AE	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AF	15-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	19-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	25-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	27-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	31-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	33-2-12	-25	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007660



Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:18:58 2020 Page 1

ID:DMCubINVR6TsFoe31v8l zns1l-x2qeJGBoaF2nprbcaNm9BWHeyQ8EpgGa1mZakzME7l

1-3-6 0-0 5-10-8 11-9-6 17-7-0 10-6-4 20-8-4 22-4-10 29-3-6 35-2-0 36-5-8
1-3-8 5-10-8 5-10-14 59-10 1-1-4 2-0-0 2-0-0 3-6 5-10-13 5-10-8 1-3-8

Scale = 1/8" = 1'-0"

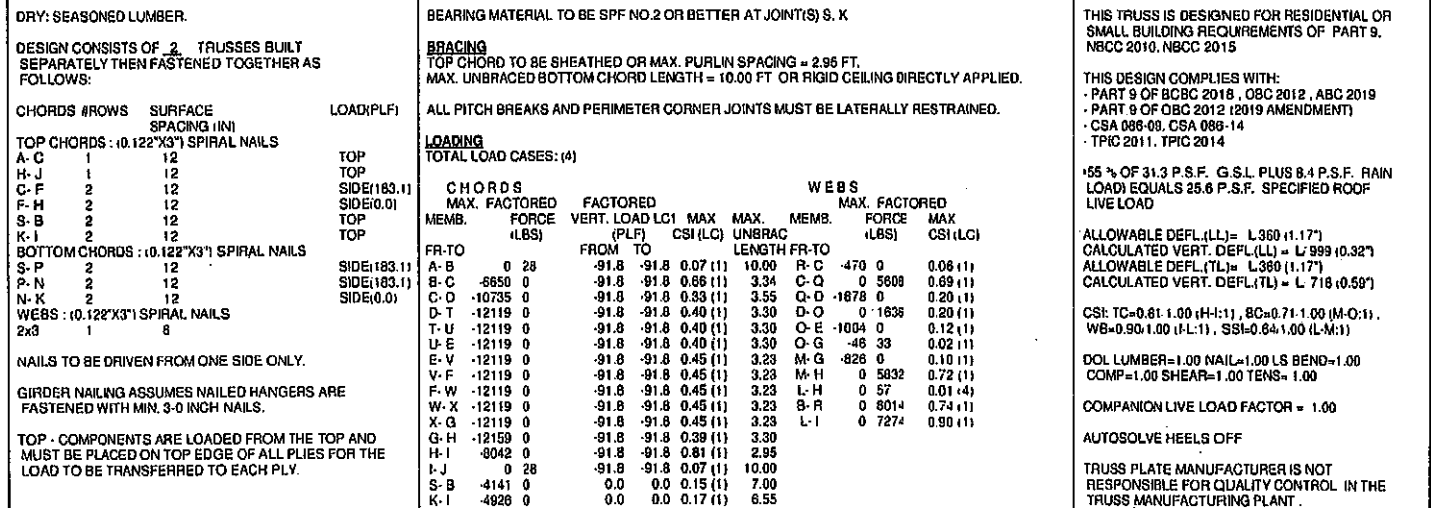

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN.C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

55 % OF 31.3 P.S.F. G.S.L PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.17")
CALCULATED VERT. DEFL.(LL)= L/999 (0.32")
ALLOWABLE DEFL.(TL)= L/360 (1.17")
CALCULATED VERT. DEFL.(TL)= L/718 (0.59")

CS: TC=0.81:1.00 (H:1), BC=0.71:1.00 (M:O), WB=0.90:1.00 (P:L), SS=0.84:1.00 (L:M:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (R) (INPUT = 0.90)
JSI METAL= 0.93 (P) (INPUT = 1.00)

CONTINUED ON PAGE

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T40Z	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Tue Apr 28 10:19:58 2020 Page 2
ID:DMCubINVR6TstFoe31v6J zns11-x2qeJGBaF2pnibcaNm9BWHeyQ8EpcGa1mZakzME7I

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-p	MT20	4.0	12.0	1.00	5.50
C	TTWW+m	MT20	7.0	8.0	Edge	
D	TMWW-l	MT20	5.0	6.0		
E	TMWW-w	MT20	3.0	6.0		
F	TS-l	MT20	5.0	6.0		
G	TMWW-l	MT20	5.0	6.0		
H	TTWW+m	MT20	7.0	8.0	Edge	
I	TMWW-p	MT20	4.0	12.0	1.00	5.50
K	BMWW-l+p	MT20	3.0	6.0		
L	BMWW-l	MT20	5.0	8.0	2.50	3.00
M	BMWW-l	MT20	5.0	8.0	2.50	3.25
N	BS-l	MT20	6.0	9.0		
O	BMWW-l	MT20	5.0	8.0		
P	BS-l	MT20	6.0	9.0		
Q	BMWW-l	MT20	5.0	8.0	2.50	3.25
R	BMWW-l	MT20	5.0	8.0	2.50	3.00
S	BMWW-l+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
Q	11-11-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
T	13-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
U	15-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	18-8-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
W	20-8-4	-159	-159	---	BACK	VERT	TOTAL	---	C1
X	22-8-4	-159	-159	---	BACK	VERT	TOTAL	---	C1
Y	10-7-8	-1171	-1171	---	BACK	VERT	TOTAL	---	C1
Z	15-11-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
AA	18-8-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AB	20-8-4	-32	-32	---	BACK	VERT	TOTAL	---	C1
AC	22-8-4	-32	-32	---	BACK	VERT	TOTAL	---	C1
AD	24-7-8	-2237	-2237	---	BACK	VERT	TOTAL	---	C1
AE	26-8-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AF	28-8-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AG	30-8-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AH	32-8-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AI	33-5-4	-121	-121	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2007661

JOB NAME 408224	TRUSS NAME T41	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Faharack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:59 2020 Page 1
ID:DMCubINVR6T3IFoe31v61 zns11-PFO0WcCQLZAIQXloAHu?h03QDMnRzI?PphW7IAzME7k

1-3-8 0-0 1-3-8 1-0-8 1-0-8 3-10-0 1-0-8 6-8-1 14-4-9 6-8-1 20-9-7 6-8-1 27-3-8 3-10-0 3-1-8 4-0-8 35-2-0 38-5-8
1-3-8 0-0 1-3-8 1-0-8 1-0-8 3-10-0 1-0-8 6-8-1 14-4-9 6-8-1 20-9-7 6-8-1 27-3-8 3-10-0 3-1-8 4-0-8 35-2-0 38-5-8
Scale = 1:57.6

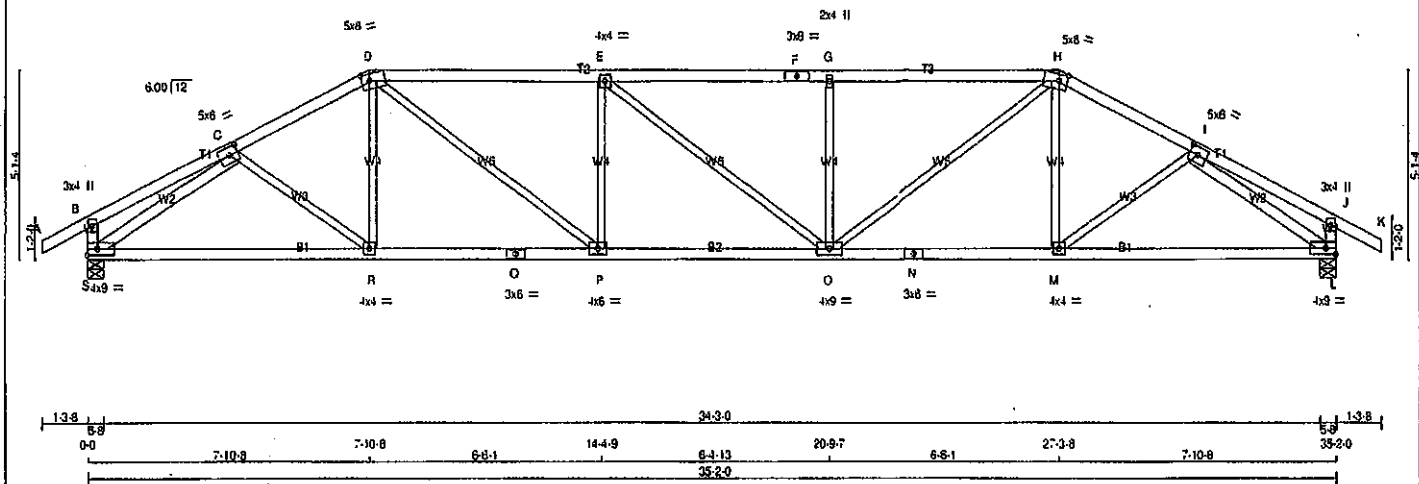

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMV+p	MT20	3.0	4.0	
C TMVW-i	MT20	5.0	6.0	2.50 2.75
D TTWW-m	MT20	5.0	8.0	2.25 2.75
E TMVW-i	MT20	4.0	4.0	
F TS-i	MT20	3.0	8.0	
G TMVW-w	MT20	2.0	4.0	
H TTWW-m	MT20	5.0	8.0	2.25 2.75
I TMVW-i	MT20	5.0	8.0	2.50 2.75
J TMV+p	MT20	3.0	4.0	
L BMVW-i	MT20	4.0	4.0	Edge
M BMVW-i	MT20	4.0	4.0	
N BS-i	MT20	3.0	6.0	
O BMVW-i	MT20	4.0	9.0	
P BMVW-i	MT20	4.0	6.0	
Q BS-i	MT20	3.0	6.0	
R BMVW-i	MT20	4.0	4.0	
S BMVW-i	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
	FACTORED	MAXIMUM FACTORED	INPUT
	GROSS REACTION	GROSS REACTION	BRG
JT	VERT	HORZ	DOWN
S	2063	0	2063
L	2063	0	2063

UNFACTORED REACTIONS			
1ST LCASE	SNOW	LIVE	PERM. LIVE
JT	COMBINED	SNOW	LIVE
S	1457	989	0
L	1457	989	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.94 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED	FACTORED	WEBS
	FORCE	VERT. LOAD	MAX. FACTORED
	(LBS)	(PLF)	FORCE
			(LBS)
			CSH(LO)
FR-TO		FROM TO	
A-B	0 28	-91.8 -91.8 0.12 (1)	10.00
B-C	0 16	-91.8 -91.8 0.20 (1)	10.00
C-D	-2799 0	-91.8 -91.8 0.32 (1)	3.88
D-E	-3508 0	-91.8 -91.8 0.95 (1)	2.94
E-F	-3507 0	-91.8 -91.8 0.93 (1)	2.94
F-G	-3507 0	-91.8 -91.8 0.93 (1)	2.94
G-H	-3507 0	-91.8 -91.8 0.94 (1)	2.95
H-I	-2799 0	-91.8 -91.8 0.32 (1)	3.88
I-J	0 16	-91.8 -91.8 0.20 (1)	10.00
J-K	0 28	-91.8 -91.8 0.12 (1)	10.00
K-L	-270 0	0.0 0.0 0.03 (1)	7.81
L-J	-270 0	0.0 0.0 0.03 (1)	7.81
S-R	0 2417	-18.5 -18.5 0.53 (1)	10.00
R-O	0 2489	-18.5 -18.5 0.54 (1)	10.00
Q-P	0 2489	-18.5 -18.5 0.54 (1)	10.00
P-O	0 3509	-18.5 -18.5 0.64 (1)	10.00
O-N	0 2489	-18.5 -18.5 0.54 (1)	10.00
N-M	0 2489	-18.5 -18.5 0.54 (1)	10.00
M-L	0 2417	-18.5 -18.5 0.53 (1)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.21')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.41')

CSH: TC=0.95/1.00 (D-E:1), BC=0.64/1.00 (O-P:1), WB=0.83/1.00 (L-I:1), SSI=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 .354 1887 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (L) (INPUT = 0.90)
JSI METAL = 0.77 (L) (INPUT = 1.00)

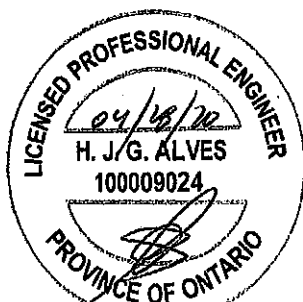


Structural component only
DWG# T-2007662

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T42	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Metek Industries, Inc. Tue Apr 28 10:20:01 2020 Page 1

ID:DMCubINVR6TsiFoe31v6I_zns1I-LdWnxHEpIAQpFSAHixTmP8U9V7RFJIG??En3zME7I

1-3.8 0.0 5-0.8 5-0.8 4-10.0 3-10.8 7-8.8 17-7.0 7-8.8 25-3.8 4-10.0 30-1.8 5-0.8 35-2.0 36-4.8 1-3.8
Scale = 1:57.6

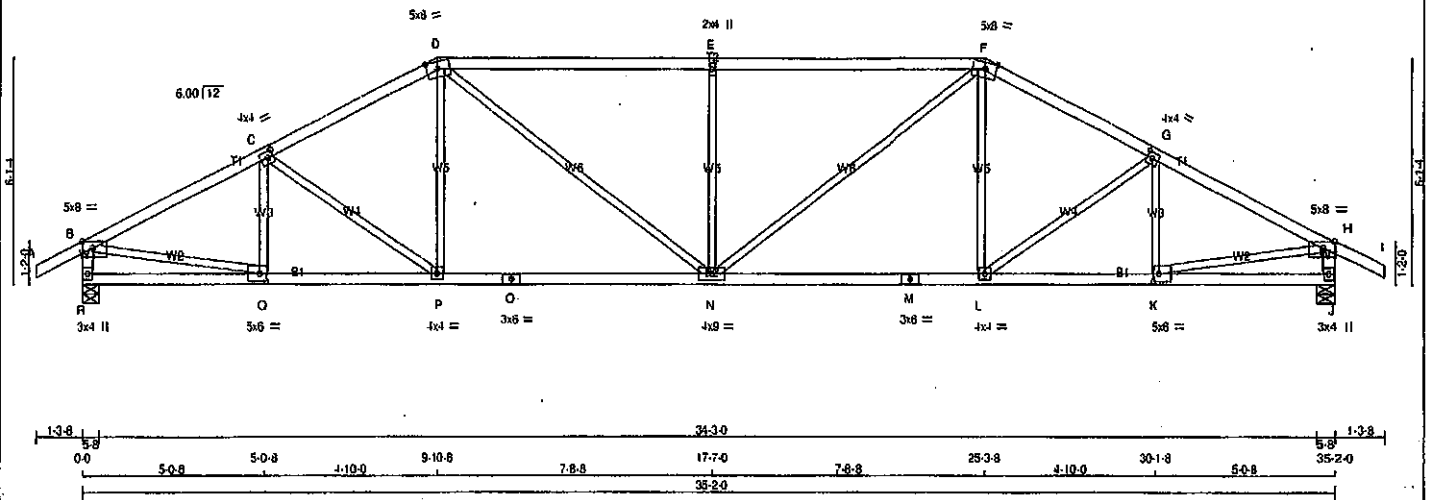

LUMBER	N L G A RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - I	2x4	DRY	No.2	SPF	
R - B	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
R - O	2x4	DRY	No.2	SPF	
O - M	2x4	DRY	No.2	SPF	
M - J	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table in notes)	PLATES	W	LEN	Y	X
JT TYPE					
B TMWW-p	MT20	5.0	8.0	Edge	3.50
C TMWW-I	MT20	4.0	4.0	2.00	1.75
D TTWW-m	MT20	5.0	8.0	2.25	3.75
E TMWW-w	MT20	2.0	4.0		
F TTWW-m	MT20	5.0	8.0	2.25	3.75
G TMWW-I	MT20	4.0	4.0	2.00	1.75
H TMWW-p	MT20	5.0	8.0	Edge	3.50
J BMV-I-p	MT20	3.0	4.0		
K BMWW-I	MT20	5.0	8.0	2.50	2.00
L BMWW-I	MT20	4.0	4.0		
M BS-I	MT20	3.0	8.0		
N BMWWW-I	MT20	4.0	9.0		
O BS-I	MT20	3.0	8.0		
P BMWW-I	MT20	4.0	4.0		
Q BMWW-I	MT20	5.0	8.0	2.50	2.00
R BMV-I-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG	
JT VERT	HORZ	DOWN	HORZ	UPLIFT
R 2063	0	2063	0	5-8
J 2063	0	2063	0	6-8

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS						
JT COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
R 1457	969	0	0	0	0	0	0
J 1457	969	0	0	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.78 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSF (LC)	MEMB.	FORCE (LBS)	MAX. CSF (LC)
FR-TO		FROM TO		FR-TO		
A-B	0 28	-91.8 -91.8 0.12 (1)	10.00	Q-C	-353 0	0.08 (1)
B-C	-2834 0	-91.8 -91.8 0.39 (1)	3.81	C-P	-210 0	0.13 (1)
C-D	-2687 0	-91.8 -91.8 0.37 (1)	3.91	P-D	0 246	0.08 (4)
D-E	-3080 0	-91.8 -91.8 0.97 (1)	2.78	D-N	0 844	0.19 (1)
E-F	-3080 0	-91.8 -91.8 0.97 (1)	2.78	N-E	-872 0	0.51 (1)
F-G	-2687 0	-91.8 -91.8 0.37 (1)	3.91	N-F	0 844	0.19 (1)
G-H	-2834 0	-91.8 -91.8 0.39 (1)	3.81	L-F	0 246	0.08 (4)
H-I	0 28	-91.8 -91.8 0.12 (1)	10.00	L-G	-210 0	0.13 (1)
R-B	-2018 0	0.0 0.0 0.20 (1)	5.94	K-G	-353 0	0.08 (1)
J-H	-2018 0	0.0 0.0 0.20 (1)	5.94	B-Q	0 2591	0.58 (1)
				K-H	0 2591	0.58 (1)
R-Q	0 0	-18.5 -18.5 0.10 (4)	10.00			
O-P	0 2555	-18.5 -18.5 0.51 (1)	10.00			
P-O	0 2388	-18.5 -18.5 0.49 (1)	10.00			
O-N	0 2388	-18.5 -18.5 0.49 (1)	10.00			
N-M	0 2388	-18.5 -18.5 0.49 (1)	10.00			
M-L	0 2388	-18.5 -18.5 0.49 (1)	10.00			
L-K	0 2555	-18.5 -18.5 0.51 (1)	10.00			
K-J	0 0	-18.5 -18.5 0.10 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/999 (0.17")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/999 (0.34")

CSE TC=0.97 1.00 (D-E:1), BC=0.51 1.00 (P-Q:1), WB=0.58 1.00 (B-Q:1), SS=0.34 1.00 (D-E:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1067 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (F) (INPUT = 0.90)
JSI METAL = 0.75 (M) (INPUT = 1.00)




Structural component only
DWG# T-2007663

JOB NAME 408224	TRUSS NAME T43	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Tue Apr 28 10:20:02 2020 Page 1
ID:DMCubINVR6TstFos31v6l_zns11-q498dElaUYGHO1NrQSiJ1h7BZrVAIQsV/knJVzME7h

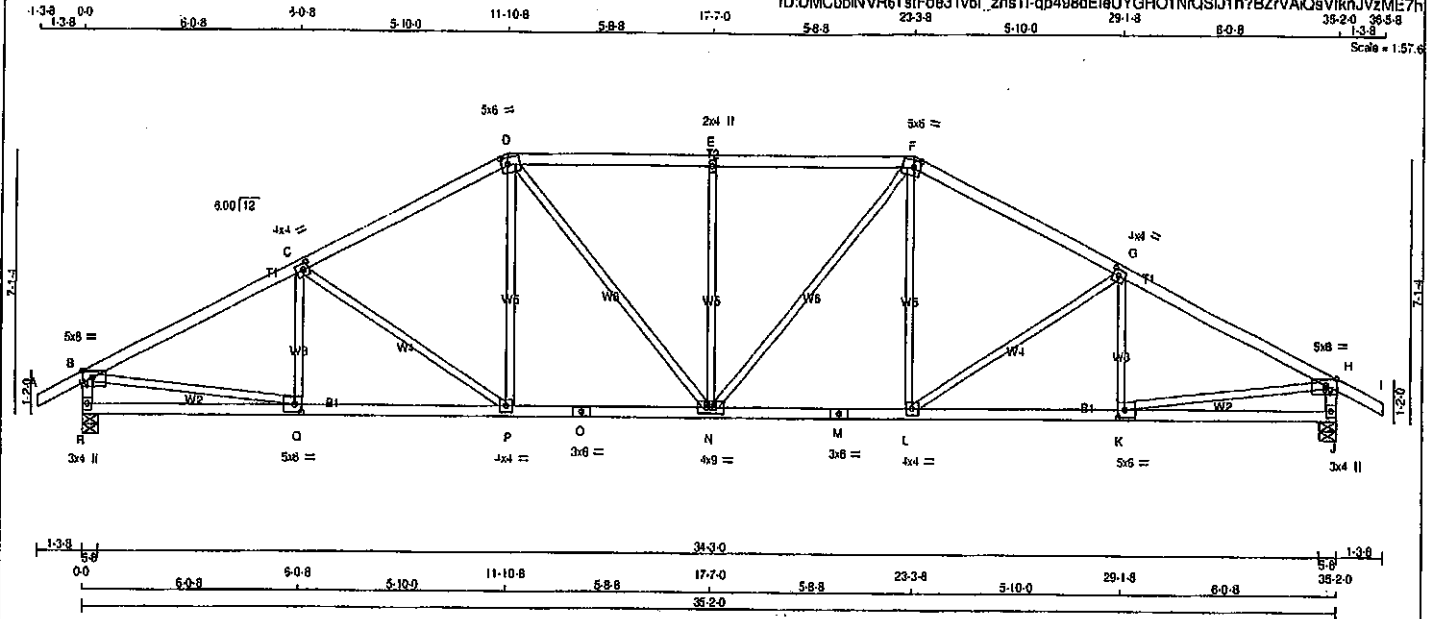

CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - B	2x4	DRY	No.2
B - H	2x4	DRY	No.2
H - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
A - B	MT20	5.0	8.0	Edge	3.50
C - D	MT20	4.0	4.0	2.00	1.75
D - E	MT20	5.0	8.0	2.25	2.00
E - F	MT20	2.0	4.0		
F - G	MT20	5.0	8.0	2.25	2.00
G - H	MT20	4.0	4.0	2.00	1.75
H - I	MT20	5.0	8.0	Edge	3.50
I - J	MT20	3.0	4.0		
J - K	MT20	5.0	8.0	2.50	2.25
K - L	MT20	4.0	4.0		
L - M	MT20	3.0	4.0		
M - N	MT20	4.0	4.0		
N - O	MT20	3.0	4.0		
O - P	MT20	4.0	4.0		
P - Q	MT20	5.0	8.0	2.50	2.25
Q - R	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORIZ	UPLIFT
R	2053	0	0	5-8
J	2053	0	0	5-8

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1457	989	0	0	0	488	0
J	1457	989	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CSI (LC)	MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CSI (LC)
FR-TO				FR-TO			
A-B	0	-91.8	-91.8 (1.12)	Q-C	-255	12	0.07 (1)
B-C	-2889	0	-91.8 (1.12)	C-P	-435	0	0.42 (1)
C-D	-2539	0	-91.8 (1.12)	P-D	0	350	0.08 (1)
D-E	-2559	0	-91.8 (1.12)	D-N	0	482	0.11 (1)
E-F	-2559	0	-91.8 (1.12)	N-E	-541	0	0.56 (1)
F-G	-2539	0	-91.8 (1.12)	N-F	0	482	0.11 (1)
G-H	-2889	0	-91.8 (1.12)	L-F	0	350	0.08 (1)
H-I	0	-91.8	-91.8 (1.12)	L-G	-435	0	0.42 (1)
R-B	-2014	0	0.0 (0.20)	K-G	-255	12	0.07 (1)
J-H	-2014	0	0.0 (0.20)	B-O	0	2635	0.59 (1)
				K-H	0	2635	0.59 (1)
R-O	0	-18.5	-18.5 (0.15)				
Q-P	0	-18.5	-18.5 (0.15)				
P-O	0	-18.5	-18.5 (0.15)				
O-N	0	-18.5	-18.5 (0.15)				
N-M	0	-18.5	-18.5 (0.15)				
M-L	0	-18.5	-18.5 (0.15)				
L-K	0	-18.5	-18.5 (0.15)				
K-J	0	-18.5	-18.5 (0.15)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (L) = L/360 (1.17")
CALCULATED VERT. DEFL. (L) = L/999 (0.15")
ALLOWABLE DEFL. (L) = L/360 (1.17")
CALCULATED VERT. DEFL. (L) = L/999 (0.28")

CSI: TC=0.58/1.00 (H:H), SC=0.49/1.00 (K:L), WB=0.59/1.00 (H:K), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.89 (Q) (INPUT = 0.90)

JSI METAL = 0.89 (M) (INPUT = 1.00)



Structural component only
DWG# T-2007684

JOB NAME 408224	TRUSS NAME T44	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:20:03 2020 Page 1 ID:DMCubINVR6TstFoe31v6I zns11-10dXmZFWoog7vYcZP7xsEE72ACv8c7kJKx2ME7g 35-2-0 36-5-8 Scale = 1:58.3	

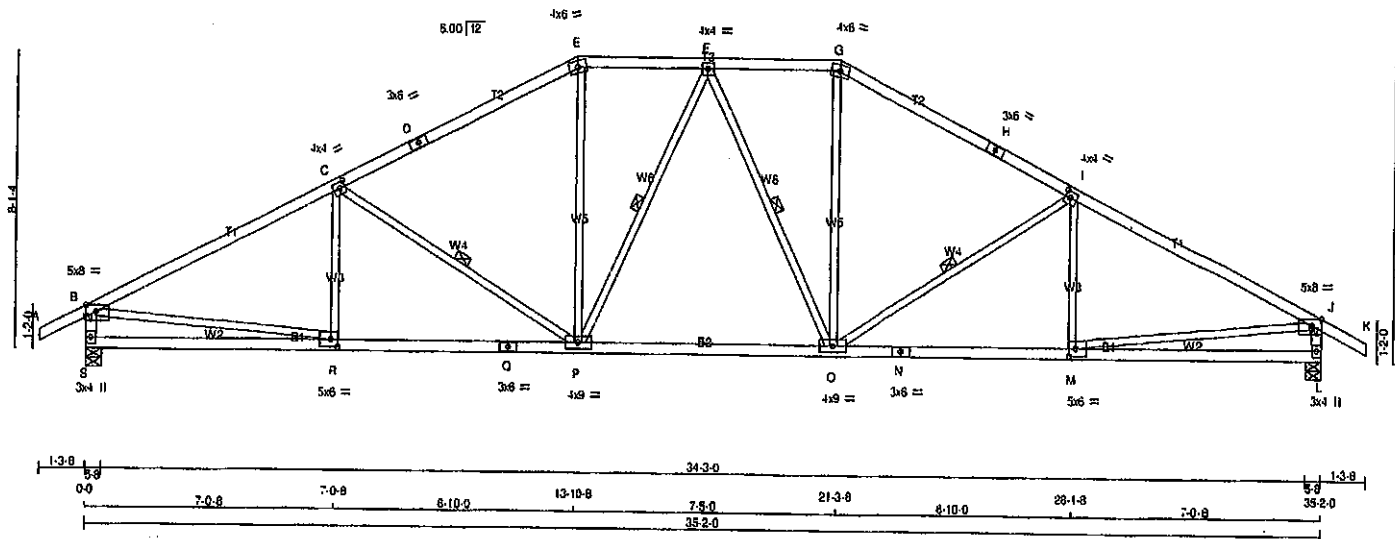

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY No.2	SPF
D - E	2x4	DRY No.2	SPF
E - G	2x4	DRY No.2	SPF
G - H	2x4	DRY No.2	SPF
H - K	2x4	DRY No.2	SPF
S - B	2x4	DRY No.2	SPF
L - J	2x4	DRY No.2	SPF
S - O	2x4	DRY No.2	SPF
O - N	2x4	DRY No.2	SPF
N - L	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMWV-p	MT20	5.0	8.0	Edge 3.50
C	TMWV-t	MT20	4.0	4.0	2.00 1.75
D	TS-t	MT20	3.0	6.0	
E	TTW-m	MT20	4.0	6.0	
F	TMWV-t	MT20	4.0	4.0	
G	TTW-m	MT20	4.0	6.0	
H	TS-t	MT20	3.0	6.0	
I	TMWV-t	MT20	4.0	4.0	2.00 1.75
J	TMWV-p	MT20	5.0	8.0	Edge 3.50
L	BMV1-p	MT20	3.0	4.0	
M	BMWV-t	MT20	5.0	6.0	2.50 2.25
N	BS-t	MT20	3.0	6.0	
O	BMWV-t	MT20	4.0	9.0	
P	BMWV-t	MT20	4.0	9.0	
Q	BS-t	MT20	3.0	6.0	
R	BMWV-t	MT20	5.0	6.0	2.50 2.25
S	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	UP	BRG	BRG	
S	2063	0	0	2063	0	0	5-8	5-8	
L	2063	0	0	2063	0	0	5-8	5-8	

UNFACTORED REACTIONS		1ST LCASE		MAX. MIN. COMPONENT REACTIONS		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	DEAD	SOIL
S	1457	969	0	0	0	0	0	488	0
L	1457	969	0	0	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-P, F-P, F-O, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1	MAX	MAX. (LC)	MEMB.	FORCE (LBS)	MAX	MAX. (LC)
FR-TO		FROM	TO	LENGTH	FR-TO				
A-B	0 28	-91.8	-91.8	0.12 (1)	10.00	R-C	-182 52	0.08 (1)	
B-C	-2908 0	-91.8	-91.8	0.83 (1)	3.25	C-P	-637 0	0.29 (1)	
C-D	-2373 0	-91.8	-91.8	0.72 (1)	3.66	P-E	0 674	0.15 (1)	
D-E	-2373 0	-91.8	-91.8	0.72 (1)	3.66	P-F	-222 0	0.11 (1)	
E-F	-2100 0	-91.8	-91.8	0.19 (1)	4.53	F-O	-222 0	0.11 (1)	
F-G	-2100 0	-91.8	-91.8	0.19 (1)	4.53	O-G	0 674	0.15 (1)	
G-H	-2373 0	-91.8	-91.8	0.72 (1)	3.66	O-I	-637 0	0.29 (1)	
H-I	-2373 0	-91.8	-91.8	0.72 (1)	3.66	M-I	-182 52	0.06 (1)	
I-J	-2908 0	-91.8	-91.8	0.83 (1)	3.25	B-R	0 2649	0.60 (1)	
J-K	0 28	-91.8	-91.8	0.12 (1)	10.00	M-J	0 2649	0.60 (1)	
S-B	-2008 0	0.0	0.0	0.20 (1)	5.96				
L-J	-2008 0	0.0	0.0	0.20 (1)	5.96				
S-R	0 0	-18.5	-18.5	0.20 (4)	10.00				
R-O	0 2630	-18.5	-18.5	0.52 (1)	10.00				
O-P	0 2630	-18.5	-18.5	0.52 (1)	10.00				
P-Q	0 2193	-18.5	-18.5	0.45 (1)	10.00				
Q-N	0 2630	-18.5	-18.5	0.52 (1)	10.00				
N-M	0 2630	-18.5	-18.5	0.52 (1)	10.00				
M-L	0 0	-18.5	-18.5	0.20 (4)	10.00				

TOTAL WEIGHT = 2 X 145 = 291 LB

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.8 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.30")

CSI: TC=0.83/1.00 (I-J:1), BC=0.52/1.00 (M-O:1), WB=0.60/1.00 (J-M:1), SS=0.28/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (M) (INPUT = 0.90)
JSI METAL= 0.79 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007665

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T45	2	1	GREEN PARK HOMES	


Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 26 10:20:04 2020 Page 1

ID:DMCubINV6TstFoe31v6l_zns11-mCBvZJGY950_XiB1zrUBOSmOWNWqecdyDuNoZME71

-1-3-8 0-0 5-5-3 5-5-3 5-2-11 10-7-13 5-2-11 15-10-8 3-5-0 19-3-8 5-2-11 21-6-3 5-2-11 29-8-13 5-5-3 35-2-0 36-5-8 1-3-8

Scale = 1:58.3

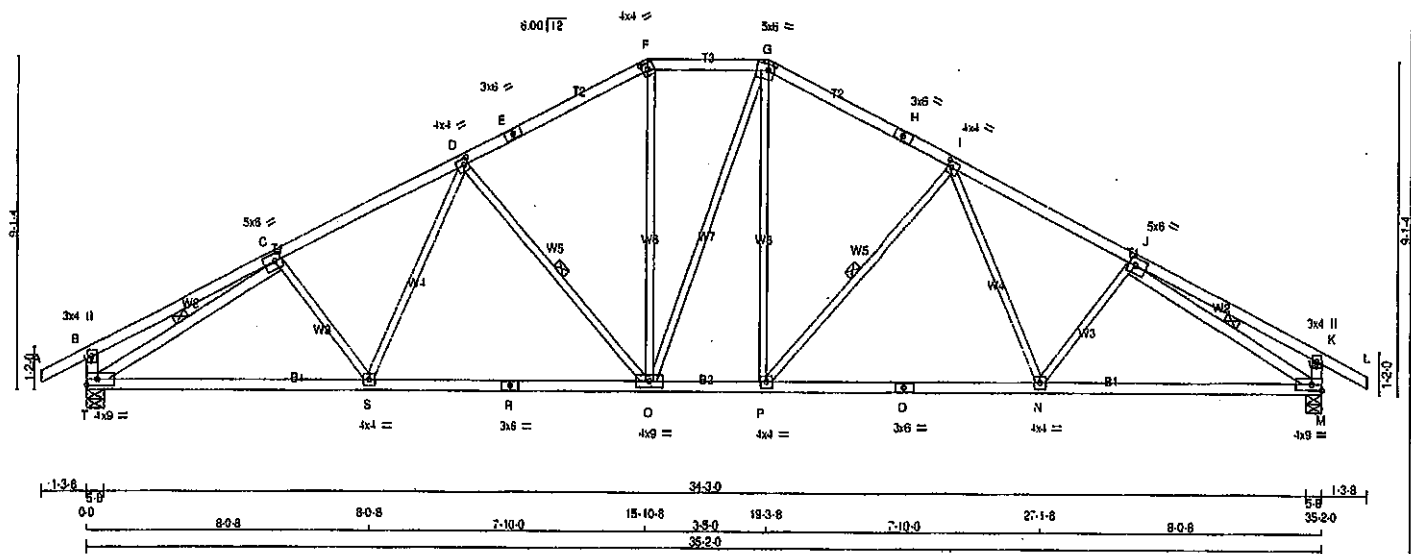

TOTAL WEIGHT = 2 X 155 = 310 lb

(M/F)

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - E	2x4	DRY	No.2
F - G	2x4	DRY	No.2
H - I	2x4	DRY	No.2
J - K	2x4	DRY	No.2
L - M	2x4	DRY	No.2
N - O	2x4	DRY	No.2
P - Q	2x4	DRY	No.2
R - S	2x4	DRY	No.2
T - U	2x4	DRY	No.2
V - W	2x4	DRY	No.2
X - Y	2x4	DRY	No.2
Z - AA	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
T - C	2x4	DRY	No.2
J - M	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
	FACTORED	MAXIMUM FACTORED	INPUT	REQD					
	GROSS REACTION	GROSS REACTION	BRG	BRG					
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
T	2083	0	2083	0	0	5-8	5-8		
M	2083	0	2083	0	0	5-8	5-8		
UNFACTORED REACTIONS									
	1ST CASE	MAX.	MIN.	COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
T	1457	989	0	0	0	0	0		
M	1457	989	0	0	0	0	0		
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, M									
BRACING									
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.88 FT.									
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.									
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.									
1 LATERAL BRACE(S) AT 1/2 LENGTH OF D-Q, I-P, C-T, J-M.									
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW									
LOADING									
TOTAL LOAD CASES: (4)									

DESIGN CRITERIA			
SPECIFIED LOADS:			
TOP CH.	LL	=	25.8 PSF
DL	=	8.0 PSF	
BOT CH.	LL	=	0.0 PSF
DL	=	7.4 PSF	
TOTAL LOAD	=	39.0 PSF	
SPACING = 24.0 IN./C/C			
LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12			
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015			
THIS DESIGN COMPLIES WITH:			
- PART 9 OF CBC 2018, CBC 2012, ABC 2019			
- PART 9 OF CBC 2012 (2019 AMENDMENT)			
- CSA 088-08, CSA 088-14			
- TPIC 2011, TPIC 2014			
155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD			
ALLOWABLE DEFL.(LL) = L/360 (1.17')			
CALCULATED VERT. DEFL.(LL) = L/999 (0.14')			
ALLOWABLE DEFL.(TL) = L/360 (1.17')			
CALCULATED VERT. DEFL.(TL) = L/999 (0.29')			
CSF: TC=0.40/1.00 (J-I), BC=0.58/1.00 (M-N), WB=0.61/1.00 (J-M), SS=0.20/1.00 (G-I)			
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10			
COMPANION LIVE LOAD FACTOR = 1.00			
AUTOSOLVE HEELS OFF			
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.			
NAIL VALUES			
PLATE GRIP(DRY)	SHEAR	SECTION	
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618	354	1667 788 1987 1856
PLATE PLACEMENT TOL. = 0.250 inches			
PLATE ROTATION TOL. = 5.0 Deg.			
JSI GRIP = 0.89 (F) (INPUT = 0.90)			
JSI METAL = 0.83 (O) (INPUT = 1.00)			

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMV-p	MT20	3.0	4.0		
C TMWW-l	MT20	5.0	6.0	2.50	2.25
D TMWW-l	MT20	4.0	4.0	2.00	1.50
E TS-l	MT20	3.0	6.0		
F TTW-h	MT20	4.0	4.0	2.00	1.75
G TTWW-m	MT20	5.0	6.0	2.00	2.00
H TS-l	MT20	3.0	6.0		
I TMWW-l	MT20	4.0	4.0	2.00	1.50
J TMWW-l	MT20	5.0	6.0	2.50	2.25
K TMV-p	MT20	3.0	4.0		
M BMVW-l	MT20	4.0	9.0		Edge
N, P, S					
N BMWW-l	MT20	4.0	4.0		
O BS-l	MT20	3.0	6.0		
Q BMWWW-l	MT20	5.0	6.0	2.50	2.25
R BS-l	MT20	3.0	6.0		
T BMVW-l	MT20	4.0	9.0		Edge
Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.					

CHORDS									
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CSI (I/C)	UNBRAC LENGTH	FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (I/C)
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00	C-S	-110	37
B-C	0	20	-91.8	-91.8	0.32 (1)	10.00	S-D	0	278
C-D	-2760	0	-91.8	-91.8	0.40 (1)	3.86	D-Q	-892	0
D-E	-2187	0	-91.8	-91.8	0.38 (1)	4.30	Q-F	0	614
E-F	-2187	0	-91.8	-91.8	0.38 (1)	4.30	Q-G	0	4
F-G	-1925	0	-91.8	-91.8	0.18 (1)	4.71	P-G	0	609
G-H	-2165	0	-91.8	-91.8	0.38 (1)	4.30	P-I	-883	0
H-I	-2165	0	-91.8	-91.8	0.38 (1)	4.30	I-N	0	279
I-J	-2761	0	-91.8	-91.8	0.40 (1)	3.86	N-J	-110	37
J-K	0	20	-91.8	-91.8	0.32 (1)	10.00	T-C	-3042	0
K-L	0	28	-91.8	-91.8	0.12 (1)	10.00	J-M	-3043	0
T-B	-325	0	0.0	0.0	0.03 (1)	7.81			
M-K	-325	0	0.0	0.0	0.03 (1)	7.81			
T-S	0	2537	-18.5	-18.5	0.56 (1)	10.00			
S-R	0	2363	-18.5	-18.5	0.53 (1)	10.00			
R-Q	0	2363	-18.5	-18.5	0.53 (1)	10.00			
Q-P	0	1924	-18.5	-18.5	0.40 (1)	10.00			
P-O	0	2362	-18.5	-18.5	0.53 (1)	10.00			
O-N	0	2362	-18.5	-18.5	0.53 (1)	10.00			
N-M	0	2538	-18.5	-18.5	0.56 (1)	10.00			




Structural component only
DWG# T-2007666

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T46	8	1	GREEN PARK HOMES	
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTak Industries, Inc. Tue Apr 28 10:20:05 2020 Page 1
ID:DMCubINVR6TslF0e31v6f_zns1t-EOInlHBwPwr9smyWY?QxkYonsaN17lBczRwqzME7e

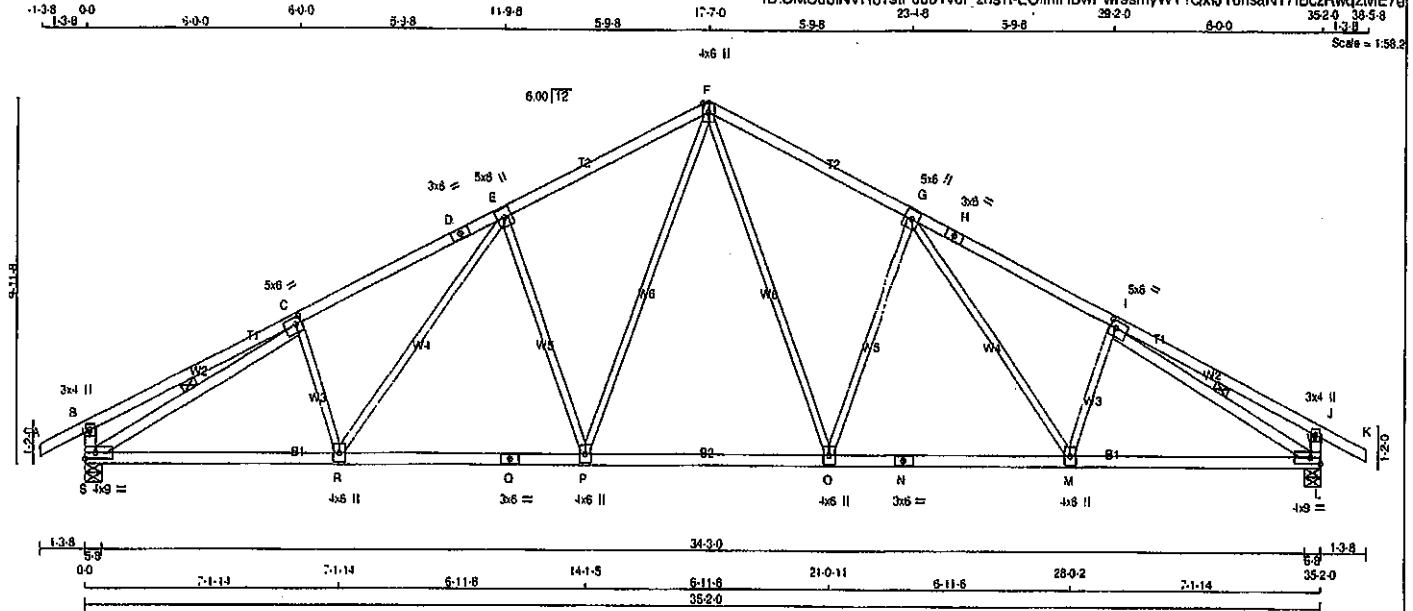

TOTAL WEIGHT = 8 X 152 = 1213 lb
(MIF)

LUMBER	N. L. Q. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - K	2x4	DRY	No.2	SPF	
S - B	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
S - Q	2x4	DRY	No.2	SPF	
Q - N	2x4	DRY	No.2	SPF	
N - L	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
S - C	2x4	DRY	No.2	SPF	
I - L	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-i	MT20	5.0	6.0	2.25	2.00
D	TS-i	MT20	3.0	6.0		
E	TMWW+i	MT20	5.0	6.0		
F	TTWW+p	MT20	4.0	6.0	Edge	
G	TMWW-i	MT20	5.0	6.0		
H	TS-i	MT20	3.0	6.0		
I	TMWW-i	MT20	5.0	6.0	2.25	2.00
J	TMV+p	MT20	3.0	4.0		
L	BMVW-i	MT20	4.0	9.0	Edge	
M, O, P, R						
M	BMVW+i	MT20	4.0	6.0		
N	BS-i	MT20	3.0	6.0		
Q	BS-i	MT20	3.0	6.0		
S	BMVW-i	MT20	4.0	9.0	Edge	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT HORZ	DOWN HORZ UPLIFT	IN-SX	IN-SX
S 2063 0	2063 0 0	5-8	5-8
L 2063 0	2063 0 0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX MIN COMPONENT REACTIONS					
JT COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S 1457 989 0	0 0	0 0	0 0	488 0	0 0	
L 1457 989 0	0 0	0 0	0 0	488 0	0 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-S, L-L

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	W E B S	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. UNBRACED LENGTH FR-TO	MEMB. FORCE (LBS)
FR-TO				
A-B	0 28	-91.8 -91.8 0.12 (1)	10.00	F-O 0 866
B-C	0 22	-91.8 -91.8 0.40 (1)	10.00	O-G -728 0
C-D	-2808 0	-91.8 -91.8 0.49 (1)	3.75	G-M 0 391
D-E	-2808 0	-91.8 -91.8 0.49 (1)	3.75	M-I -192 18
E-F	-2322 0	-91.8 -91.8 0.46 (1)	4.07	P-F 0 866
F-G	-2322 0	-91.8 -91.8 0.46 (1)	4.07	E-P -728 0
G-H	-2808 0	-91.8 -91.8 0.49 (1)	3.75	R-E 0 391
H-I	-2808 0	-91.8 -91.8 0.49 (1)	3.75	C-R -192 18
I-J	0 22	-91.8 -91.8 0.40 (1)	10.00	S-C -3064 0
J-K	0 28	-91.8 -91.8 0.12 (1)	10.00	I-L -3064 0
S-B	-344 0	0.0 0.0 0.03 (1)	7.81	
L-J	-344 0	0.0 0.0 0.03 (1)	7.81	
S-R	0 2574	-18.5 -18.5 0.53 (1)	10.00	
R-Q	0 2291	-18.5 -18.5 0.47 (1)	10.00	
Q-P	0 2291	-18.5 -18.5 0.47 (1)	10.00	
P-O	0 1762	-18.5 -18.5 0.38 (1)	10.00	
O-N	0 2291	-18.5 -18.5 0.47 (1)	10.00	
N-M	0 2291	-18.5 -18.5 0.47 (1)	10.00	
M-L	0 2574	-18.5 -18.5 0.53 (1)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOY CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.28")

CSI: TC=0.49/1.00 (C-E:1), BC=0.53/1.00 (L-M:1), WB=0.72/1.00 (E-P:1), SSI=0.22/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618 354 1667 788 1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (C) (INPUT = 0.90)
JSI METAL = 0.77 (I) (INPUT = 1.00)

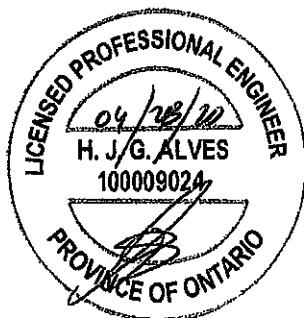


Structural component only
DWG# T-2007667

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	T47S	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:20:06 2020 Page 1
ID:DMCubINVR6TsiFoe31v6l zns1HbJg_7Hph2imOK84GWITsnqADw6o_RQGj_SGzME7d

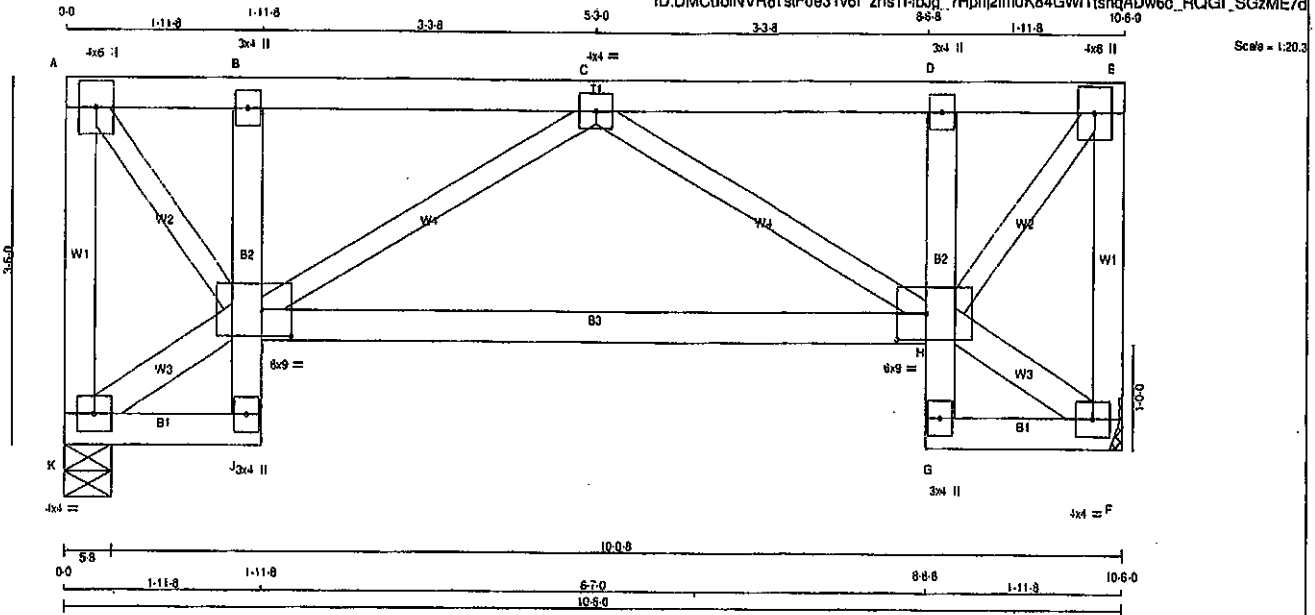

TOTAL WEIGHT = 2 X 51 = 102 lb (M/R)

LUMBER		
N. L. G. A. RULES	CHORDS	SIZE
K - A	2x4	DRY
A - E	2x4	DRY
F - E	2x4	DRY
K - J	2x4	DRY
J - B	2x4	DRY
I - H	2x4	DRY
G - D	2x4	DRY
G - F	2x4	DRY
ALL WEBS EXCEPT	2x3	DRY
K - I	2x4	DRY
H - F	2x4	DRY

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y
A	TMVW+p	MT20	4.0	6.0	
B	TMV+p	MT20	3.0	4.0	
C	TMVW-I	MT20	4.0	4.0	
D	TMV+p	MT20	3.0	4.0	
E	TMVW+p	MT20	4.0	6.0	
F	BMVW-I	MT20	4.0	4.0	
G	BMV+p	MT20	3.0	4.0	
H	BVMWVW-I	MT20	6.0	9.0	3.00
I	BVMWVW-I	MT20	6.0	9.0	3.00
J	BMV+p	MT20	3.0	4.0	
K	BMVW-I	MT20	4.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING

BEARINGS		FACTORED		GROSS REACTION		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	BRG	BRG	IN-SX	IN-SX	5-8	5-8
K	697	0	697	0	0	0	0	0	0	0	0
F	697	0	697	0	0	0	0	0	0	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	504	269	0	0	0	235	0
F	504	269	0	0	0	235	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.61 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
K-A	-667 0	0.0	0.0 0.17 (1)	7.81	K-I	-28 0	0.00 (1)
A-B	-497 0	-114.3	-114.3 0.14 (1)	6.25	A-I	0 783	0.24 (1)
B-C	-508 0	-114.3	-114.3 0.22 (1)	6.25	H-F	-28 0	0.00 (1)
C-D	-508 0	-114.3	-114.3 0.22 (1)	6.25	H-E	0 783	0.24 (1)
D-E	-497 0	-114.3	-114.3 0.14 (1)	6.25	I-C	-384 0	0.15 (1)
F-E	-667 0	0.0	0.0 0.17 (1)	7.81	C-H	-384 0	0.15 (1)
K-J	0 25	-18.5	-18.5 0.03 (4)	10.00			
J-I	0 19	0.0	0.0 0.05 (1)	10.00			
I-B	-331 0	0.0	0.0 0.05 (1)	7.81			
I-H	0 832	-18.5	-18.5 0.48 (4)	10.00			
G-H	0 19	0.0	0.0 0.05 (1)	10.00			
H-D	-331 0	0.0	0.0 0.05 (1)	7.81			
G-F	0 25	-18.5	-18.5 0.03 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
DL	=	15.0	PSF	
BOT CH.	LL	=	0.0	PSF
DL	=	7.4	PSF	
TOTAL LOAD	=	48.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.35")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.35")
CALCULATED VERT. DEFL. (TL) = L/999 (0.12")

CSI: TC=0.22(1.00 (B-C)), BC=0.46(1.00 (H-I)), WB=0.24(1.00 (E-H)), CSI=0.22(1.00 (B-C))

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618	354
	1667	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.77 (H) INPUT = 0.80
JSI METAL = 0.30 (E) INPUT = 1.00



Structural component only
DWG# T-2007668

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T48	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		Version 8.310 5 Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:20:07 2020 Page 1			
		ID:DMCubINVR6TslFoe31v6l zns11-An12CLIRS0AZOAvKez1u04OvjadNr3HbhwSY jzME7c			
		6-7-12 5-8-8 0/12 3-8-8 10-8-0			
		Scale = 1:18.2			

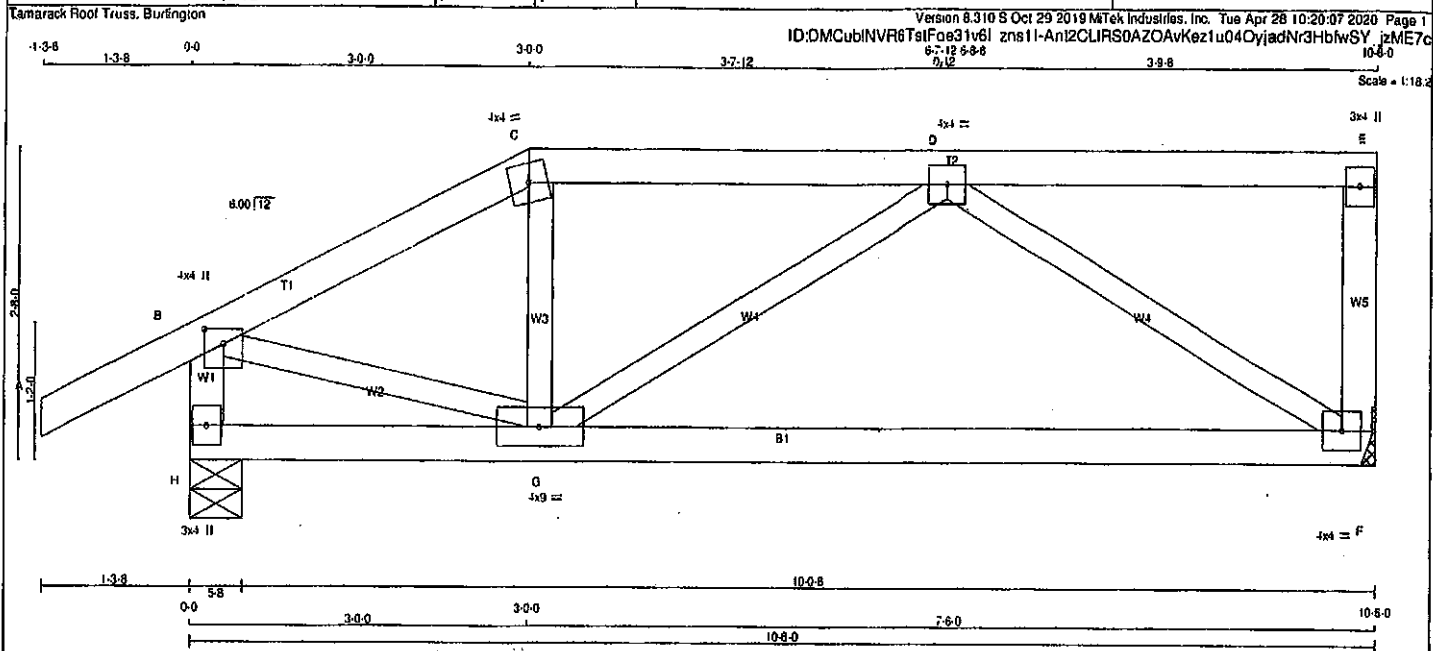

LUMBER										DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										DESIGN CRITERIA										TOTAL WEIGHT = 40 lb									
N. L. G. A. RULES										BEARINGS										SPECIFIED LOADS:																			
CHORDS		SIZE		LUMBER		DESCR.																																	
A - C		2x4		No.2		SPF				FACTORED		MAXIMUM FACTORED		INPUT		REQD																							
C - E		2x4		No.2		SPF				GROSS REACTION		GROSS REACTION		BRG		BRG																							
F - E		2x4		No.2		SPF				JT		DOWN		HORIZ		UPLIFT		IN-SX		IN-SX																			
H - B		2x4		No.2		SPF				F		579		0		579		0		MECHANICAL																			
H - F		2x4		No.2		SPF				H		703		0		703		0		5-8		5-8																	
ALL WEBS EXCEPT		2x3		No.2		SPF																																	
										A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.										TOP CH. LL = 25.8 PSF																			
																				DL = 8.0 PSF																			
																				ROT CH. LL = 6.0 PSF																			
																				DL = 7.4 PSF																			
																				TOTAL LOAD = 39.0 PSF																			
																				SPACING = 24.0 IN. O.C																			

PLATES (table is in inches)		W		LEN		Y		X	
JT TYPE		PLATES		W		LEN		Y	
B		TMW+p		4.0		4.0		1.50	
C		TMW-m		4.0		4.0			
D		TMW-w		4.0		4.0			
E		TMW+p		3.0		4.0			
F		BMW1-i		4.0		4.0			
G		BMW1-w		4.0		9.0			
H		BMW1+p		3.0		4.0			

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LBS)	MEMB.		MAX. FACTORED FORCE (LBS)
FR-TO	FROM	TO	CS (LBS)	FR-TO	FROM	TO	CS (LBS)
A-B	0	28	-91.8 -91.8 0.12 (1)	10.00	G-C	0	61 0.02 (4)
B-C	-835	0	-91.8 -91.8 0.15 (1)	6.25	G-D	-61	80 0.02 (4)
C-D	-589	0	-91.8 -91.8 0.21 (1)	6.25	D-F	-731	0 0.23 (1)
D-E	0	0	-91.8 -91.8 0.20 (1)	10.00	B-G	0	587 0.13 (1)
E-F	-135	0	0.0 0.0 0.02 (1)	7.81			
H-B	-689	0	0.0 0.0 0.07 (1)	7.81			
H-G	0	0	-18.5 -18.5 0.21 (4)	10.00			
G-F	0	619	-18.5 -18.5 0.25 (4)	10.00			

ALLOWABLE DEFL.(LL)= L/360 (0.35")

CALCULATED VERT. DEFL.(LL)= L. 999 (0.01")

ALLOWABLE DEFL.(TL)= L/360 (0.35")

CALCULATED VERT. DEFL.(TL)= L. 999 (0.09")

CSI: TC=0.21+1.00 (C-D)=, BC=0.25+1.00 (F-G)=, WB=0.23+1.00 (D-F)=, SSI=0.17 1.00 (D-E)=

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT


WEBS		MEMB.		MAX. FACTORED FORCE (LBS)	
FR-TO		FROM TO		CS (LBS)	
G-C		0 61		0.02 (4)	
D-F		-731 0		0.23 (1)	
B-G		0 587		0.13 (1)	

100009024  PROVINCE OF ONTARIO Structural component only DWG# T-2007669		
--	--	--



Structural component only
DWG# T-2007669

JOB NAME 408224	TRUSS NAME T49	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Tue Apr 28 10:20:08 2020 Page 1			
		ID:DMCubINVR6TsF0e31v6l_zns1f-ezRQPhJ3DKIQ0JUWCqZ7Zix3M_zfaUMktaB5W9zME7b			
		Scale = 1:22.0			

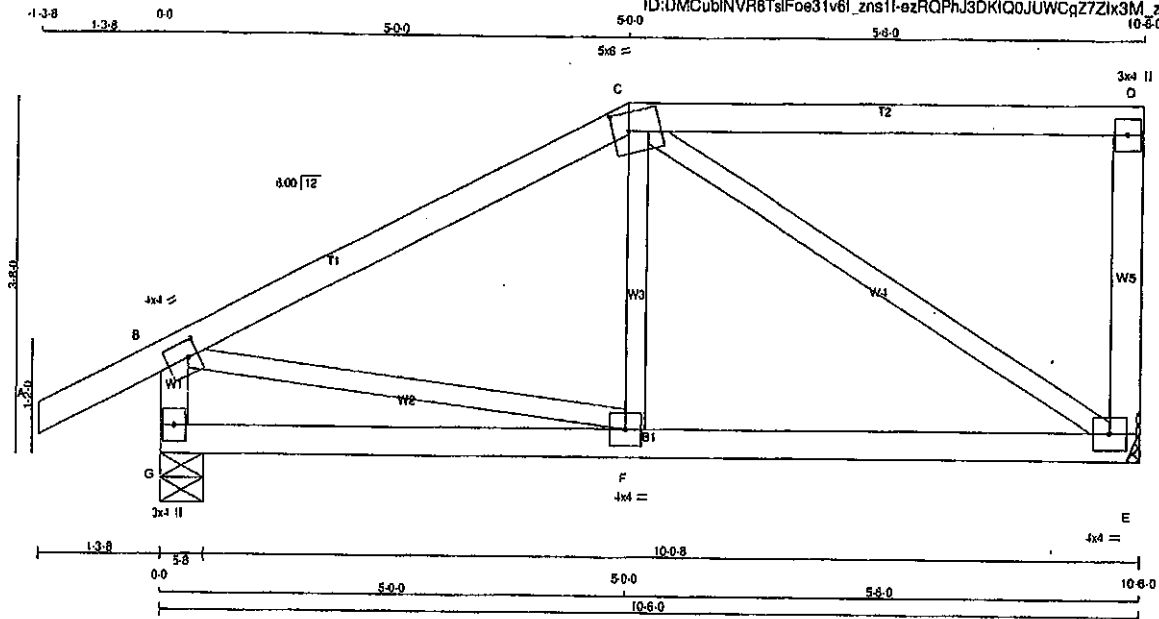

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
E - D	2x4	DRY	No.2
G - B	2x4	DRY	No.2
G - E	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMVW-1	MT20	4.0	4.0	2.00	1.25
C TTWW-m	MT20	5.0	6.0	2.25	2.00
D TMV-p	MT20	3.0	4.0		
E BMVW-1	MT20	4.0	4.0		
F BMVW-1	MT20	4.0	4.0		
G BMV-1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
E	579	0	579	0	0
G	703	0	703	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
E	409	289 0	0 0	0 0	141 0	0 0
G	495	338 0	0 0	0 0	157 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MEMB.	MAX. FORCE (LBS)
FR-TO				FR-TO	
A-B	0 28	-91.8	-91.8 0.12 (1)	F-C	0 106
B-C	-523 0	-91.8	-91.8 0.41 (1)	C-E	-549 0
C-D	0 0	-91.8	-91.8 0.47 (1)	E-F	0 474
E-D	-252 0	0.0	0.0 0.05 (1)		
G-B	-687 0	0.0	0.0 0.07 (1)		
G-F	0 0	-18.5	-18.5 0.14 (4)		
F-E	0 468	-18.5	-18.5 0.19 (4)		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.35")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.35")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSI: TC=0.47 1.00 (C-D:1), SC=0.19 1.00 (E-F:4), WB=0.37 1.00 (C-E:1), SS=0.20 1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	810 354	1667 786

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (B) INPUT = 0.90
JSI METAL= 0.26 (B) INPUT = 1.00



Structural component only
DWG# T-2007670

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:20:10 2020 Page 1
ID:DMCubINVR6TstFoe31v6l zns1l-bMYBqMKJlxY8FdevJ5bbej0KcoeV2Tf1LugCb2zME7Z



TOTAL WEIGHT = 2 X 23 = 46 lb

DESCR.
SPF
SPF
SPF
SPF
SPF

HEARINGS

A SUITABLE HANGER MECHANICAL CONNECTION IS REQUIRED AT JOINT C. MINIMUM BEARING LENGTH AT JOINT C = 1-8.

1ST LCASE MAX MIN COMPONENT REACTIONS

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) OF

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB. FR-TO	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM	TO						
D-A	319 0	0.0	0.0	0.06 (1)	7.81				
A-B	0 0	-114.3	-114.3	0.81 (1)	10.00	A-C	0 0	0.00 (1)	
C-B	319 0	0.0	0.0	0.06 (1)	7.81				
D-C	0 0	-18.5	-18.5	0.23 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
	DL	=	15.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD			=	48.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBO 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.81/1.00 (A-B:1), BC=0.23/1.00 (C-D:4),
WB=0.00/1.00 (A-C:1), SSI=0.33/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.25 (A) (INPUT = 0.90)
JSI METAL= 0.07 (A) (INPUT = 1.00)




Structural component only
DWG# T-2007671

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	G50	1	1	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 3.310 S Oct 29 2019 AM Tek Industries, Inc. Tue Apr 28 10:19:51 2020 Page 1
ID:DMCubINVR6TsiFoa31v6I_zns1f-eiv?r16OD69qTihFicI7MikFo7CC5i2EzRaiQezME7s

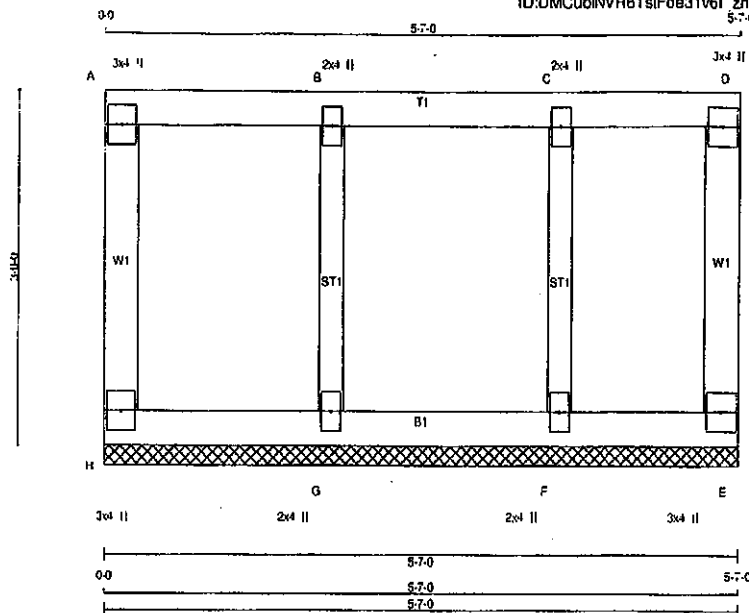

Scale = 1/8\"

LUMBER			
N. L. G. A. RULES	SIZE	DRY	NO.2
CHORDS	2x4	DRY	No.2
H - A	2x4	DRY	No.2
A - D	2x4	DRY	No.2
E - D	2x4	DRY	No.2
H - E	2x4	DRY	No.2

ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2'-0\"

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B	TMW+w	MT20	2.0	4.0		
C	TMW+w	MT20	2.0	4.0		
D	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		
F	BMW1+w	MT20	2.0	4.0		
G	BMW1+w	MT20	2.0	4.0		
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)	
FR-TO		FROM TO		FR-TO			
H-A	-101 0	0.0 0.0 0.03 (1)	7.81	G-B	-248 0	0.06 (1)	
A-B	-8 0	-114.3 -114.3 0.08 (1)	10.00	F-C	-209 0	0.05 (1)	
B-C	-8 0	-114.3 -114.3 0.08 (1)	10.00				
C-D	-8 0	-114.3 -114.3 0.08 (1)	10.00				
E-D	-80 0	0.0 0.0 0.03 (1)	7.81				
H-G	0 8	-18.5 -18.5 0.02 (4)	10.00				
G-F	0 8	-18.5 -18.5 0.02 (4)	10.00				
F-E	0 8	-18.5 -18.5 0.02 (4)	10.00				

TOTAL WEIGHT = 22 k (M/R)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 15.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 48.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS1: TC=0.09/1.00 (A-B:1), BC=0.02/1.00 (G-H:1), WB=0.08/1.00 (B-G:1), SS1=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1687 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (G) (INPUT = 0.90)
JSI METAL= 0.07 (G) (INPUT = 1.00)

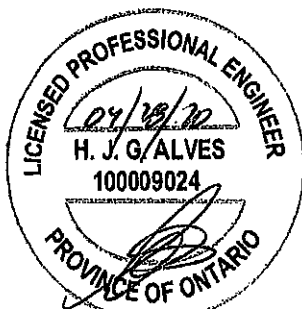


Structural component only
DWG# T-2007656

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	T51	1	1	TRUSS DESC.		

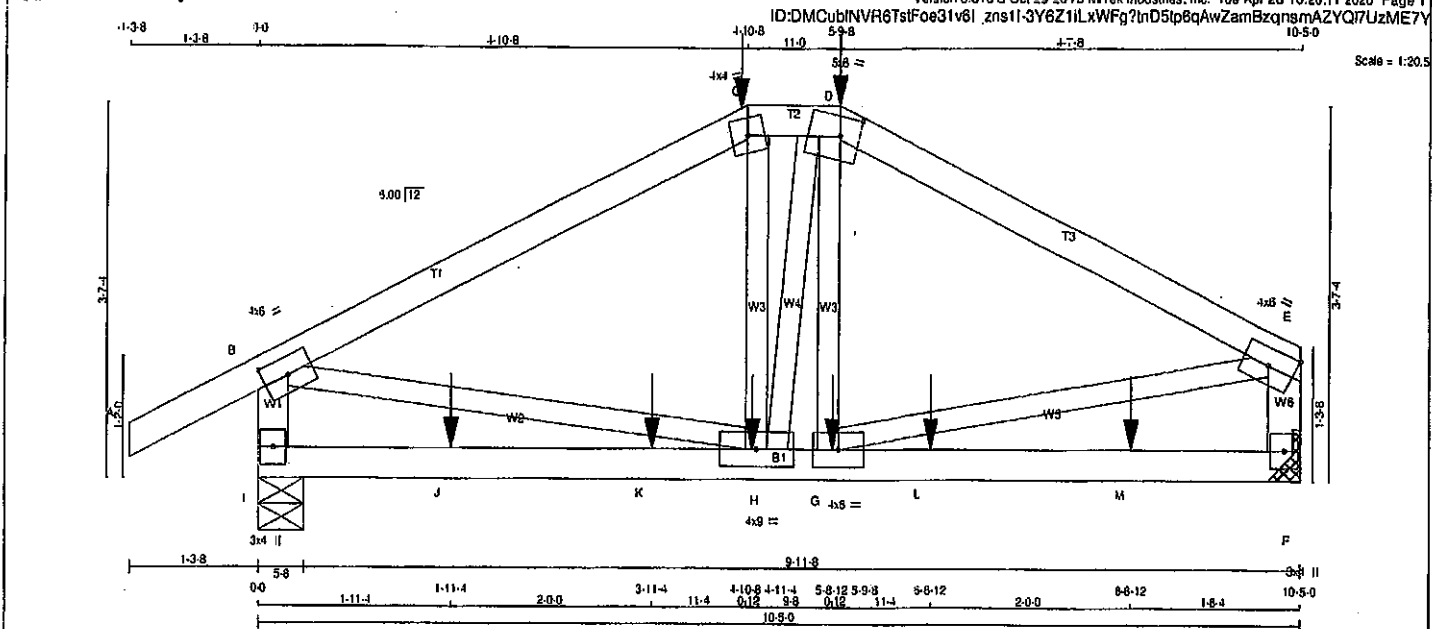

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
I - J	2x4	DRY	No.2
J - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - N	2x4	DRY	No.2
N - O	2x4	DRY	No.2
O - P	2x4	DRY	No.2
P - Q	2x4	DRY	No.2
Q - R	2x4	DRY	No.2
R - S	2x4	DRY	No.2
S - T	2x4	DRY	No.2
T - U	2x4	DRY	No.2
U - V	2x4	DRY	No.2
V - W	2x4	DRY	No.2
W - X	2x4	DRY	No.2
X - Y	2x4	DRY	No.2
Y - Z	2x4	DRY	No.2
Z - AA	2x4	DRY	No.2
AA - AB	2x4	DRY	No.2
AB - AC	2x4	DRY	No.2
AC - AD	2x4	DRY	No.2
AD - AE	2x4	DRY	No.2
AE - AF	2x4	DRY	No.2
AF - AG	2x4	DRY	No.2
AG - AH	2x4	DRY	No.2
AH - AI	2x4	DRY	No.2
AI - AJ	2x4	DRY	No.2
AJ - AK	2x4	DRY	No.2
AK - AL	2x4	DRY	No.2
AL - AM	2x4	DRY	No.2
AM - AN	2x4	DRY	No.2
AN - AO	2x4	DRY	No.2
AO - AP	2x4	DRY	No.2
AP - AQ	2x4	DRY	No.2
AQ - AR	2x4	DRY	No.2
AR - AS	2x4	DRY	No.2
AS - AT	2x4	DRY	No.2
AT - AU	2x4	DRY	No.2
AU - AV	2x4	DRY	No.2
AV - AW	2x4	DRY	No.2
AW - AX	2x4	DRY	No.2
AX - AY	2x4	DRY	No.2
AY - AZ	2x4	DRY	No.2
AZ - BA	2x4	DRY	No.2
BA - BB	2x4	DRY	No.2
BB - BC	2x4	DRY	No.2
BC - BD	2x4	DRY	No.2
BD - BE	2x4	DRY	No.2
BE - BF	2x4	DRY	No.2
BF - BG	2x4	DRY	No.2
BG - BH	2x4	DRY	No.2
BH - BI	2x4	DRY	No.2
BI - BJ	2x4	DRY	No.2
BJ - BK	2x4	DRY	No.2
BK - BL	2x4	DRY	No.2
BL - BM	2x4	DRY	No.2
BM - BN	2x4	DRY	No.2
BN - BO	2x4	DRY	No.2
BO - BP	2x4	DRY	No.2
BP - BQ	2x4	DRY	No.2
BQ - BR	2x4	DRY	No.2
BR - BS	2x4	DRY	No.2
BS - BT	2x4	DRY	No.2
BT - BU	2x4	DRY	No.2
BU - BV	2x4	DRY	No.2
BV - BW	2x4	DRY	No.2
BW - BX	2x4	DRY	No.2
BX - BY	2x4	DRY	No.2
BY - BZ	2x4	DRY	No.2
BZ - CA	2x4	DRY	No.2
CA - CB	2x4	DRY	No.2
CB - CC	2x4	DRY	No.2
CC - CD	2x4	DRY	No.2
CD - CE	2x4	DRY	No.2
CE - CF	2x4	DRY	No.2
CF - CG	2x4	DRY	No.2
CG - CH	2x4	DRY	No.2
CH - CI	2x4	DRY	No.2
CI - CJ	2x4	DRY	No.2
CJ - CK	2x4	DRY	No.2
CK - CL	2x4	DRY	No.2
CL - CM	2x4	DRY	No.2
CM - CN	2x4	DRY	No.2
CN - CO	2x4	DRY	No.2
CO - CP	2x4	DRY	No.2
CP - CQ	2x4	DRY	No.2
CQ - CR	2x4	DRY	No.2
CR - CS	2x4	DRY	No.2
CS - CT	2x4	DRY	No.2
CT - CU	2x4	DRY	No.2
CU - CV	2x4	DRY	No.2
CV - CW	2x4	DRY	No.2
CW - CX	2x4	DRY	No.2
CX - CY	2x4	DRY	No.2
CY - CZ	2x4	DRY	No.2
CZ - DA	2x4	DRY	No.2
DA - DB	2x4	DRY	No.2
DB - DC	2x4	DRY	No.2
DC - DD	2x4	DRY	No.2
DD - DE	2x4	DRY	No.2
DE - DF	2x4	DRY	No.2
DF - DG	2x4	DRY	No.2
DG - DH	2x4	DRY	No.2
DH - DI	2x4	DRY	No.2
DI - DJ	2x4	DRY	No.2
DJ - DK	2x4	DRY	No.2
DK - DL	2x4	DRY	No.2
DL - DM	2x4	DRY	No.2
DM - DN	2x4	DRY	No.2
DN - DO	2x4	DRY	No.2
DO - DP	2x4	DRY	No.2
DP - DQ	2x4	DRY	No.2
DQ - DR	2x4	DRY	No.2
DR - DS	2x4	DRY	No.2
DS - DT	2x4	DRY	No.2
DT - DU	2x4	DRY	No.2
DU - DV	2x4	DRY	No.2
DV - DW	2x4	DRY	No.2
DW - DX	2x4	DRY	No.2
DX - DY	2x4	DRY	No.2
DY - DZ	2x4	DRY	No.2
DZ - EA	2x4	DRY	No.2
EA - EB	2x4	DRY	No.2
EB - EC	2x4	DRY	No.2
EC - ED	2x4	DRY	No.2
ED - EE	2x4	DRY	No.2
EE - EF	2x4	DRY	No.2
EF - EG	2x4	DRY	No.2
EG - EH	2x4	DRY	No.2
EH - EI	2x4	DRY	No.2
EI - EJ	2x4	DRY	No.2
EJ - EK	2x4	DRY	No.2
EK - EL	2x4	DRY	No.2
EL - EM	2x4	DRY	No.2
EM - EN	2x4	DRY	No.2
EN - EO	2x4	DRY	No.2
EO - EP	2x4	DRY	No.2
EP - EQ	2x4	DRY	No.2
EQ - ER	2x4	DRY	No.2
ER - ES	2x4	DRY	No.2
ES - ET	2x4	DRY	No.2
ET - EU	2x4	DRY	No.2
EU - EV	2x4	DRY	No.2
EV - EW	2x4	DRY	No.2
EW - EX	2x4	DRY	No.2
EX - EY	2x4	DRY	No.2
EY - EZ	2x4	DRY	No.2
EZ - FA	2x4	DRY	No.2
FA - FB	2x4	DRY	No.2
FB - FC	2x4	DRY	No.2
FC - FD	2x4	DRY	No.2
FD - FE	2x4	DRY	No.2
FE - FF	2x4	DRY	No.2
FF - FG	2x4	DRY	No.2
FG - FH	2x4	DRY	No.2
FH - FI	2x4	DRY	No.2
FI - FJ	2x4	DRY	No.2
FJ - FK	2x4	DRY	No.2
FK - FL	2x4	DRY	No.2
FL - FM	2x4	DRY	No.2
FM - FN	2x4	DRY	No.2
FN - FO	2x4	DRY	No.2
FO - FP	2x4	DRY	No.2
FP - FQ	2x4	DRY	No.2
FQ - FR	2x4	DRY	No.2
FR - FS	2x4	DRY	No.2
FS - FT	2x4	DRY	No.2
FT - FU	2x4	DRY	No.2
FU - FV	2x4	DRY	No.2
FV - FW	2x4	DRY	No.2
FW - FX	2x4	DRY	No.2
FX - FY	2x4	DRY	No.2
FY - FZ	2x4	DRY	No.2
FZ - GA	2x4	DRY	No.2
GA - GB	2x4	DRY	No.2
GB - GC	2x4	DRY	No.2
GC - GD	2x4	DRY	No.2
GD - GE	2x4	DRY	No.2
GE - GF	2x4	DRY	No.2
GF - GG	2x4	DRY	No.2
GG - GH	2x4	DRY	No.2
GH - GI	2x4	DRY	No.2
GI - GJ	2x4	DRY	No.2
GJ - GK	2x4	DRY	No.2
GK - GL	2x4	DRY	No.2
GL - GM	2x4	DRY	No.2
GM - GN	2x4	DRY	No.2
GN - GO	2x4	DRY	No.2
GO - GP	2x4	DRY	No.2
GP - GQ	2x4	DRY	No.2
GQ - GR	2x4	DRY	No.2
GR - GS	2x4	DRY	No.2
GS - GT	2x4	DRY	No.2
GT - GU	2x4	DRY	No.2
GU - GV	2x4	DRY	No.2
GV - GW	2x4	DRY	No.2
GW - GX	2x4	DRY	No.2
GX - GY	2x4	DRY	No.2
GY - GZ	2x4	DRY	No.2
GZ - HA	2x4	DRY	No.2
HA - HB	2x4	DRY	No.2
HB - HC	2x4	DRY	No.2
HC - HD	2x4	DRY	No.2
HD - HE	2x4	DRY	No.2
HE - HF	2x4	DRY	No.2
HF - HG	2x4	DRY	No.2
HG - HH	2x4	DRY	No.2
HH - HI	2x4	DRY	No.2
HI - HJ	2x4	DRY	No.2
HJ - HK	2x4	DRY	No.2
HK - HL	2x4	DRY	No.2
HL - HM	2x4	DRY	No.2
HM - HN	2x4	DRY	No.2
HN - HO	2x4	DRY	No.2
HO - HP	2x4	DRY	No.2
HP - HQ	2x4	DRY	No.2
HQ - HR	2x4	DRY	No.2
HR - HS	2x4	DRY	No.2
HS - HT	2x4	DRY	No.2
HT - HU	2x4	DRY	No.2
HU - HV	2x4	DRY	No.2
HV - HW	2x4	DRY	No.2
HW - HX	2x4	DRY	No.2
HX - HY	2x4	DRY	No.2
HY - HZ	2x4	DRY	No.2
HZ - IA	2x4	DRY	No.2
IA - IB	2x4	DRY	No.2
IB - IC	2x4	DRY	No.2
IC - ID	2x4	DRY	No.2
ID - IE	2x4	DRY	No.2
IE - IF	2x4	DRY	No.2
IF - IG	2x4	DRY	No.2
IG - IH	2x4	DRY	No.2
IH - II	2x4	DRY	No.2
II - IJ	2x4	DRY	No.2
IJ - IK	2x4	DRY	No.2
IK - IL	2x4	DRY	No.2
IL - IM	2x4	DRY	No.2
IM - IN	2x4	DRY	No.2
IN - IO	2x4	DRY	No.2
IO - IP	2x4	DRY	No.2
IP - IQ	2x4	DRY	No.2
IQ - IR	2x4	DRY	No.2
IR - IS	2x4	DRY	No.2
IS - IT	2x4	DRY	No.2
IT - IU	2x4	DRY	No.2
IU - IV	2x4	DRY	No.2
IV - IW	2x4	DRY	No.2
IW - IX	2x4	DRY	No.2
IX - IY	2x4	DRY	No.2
IY - IZ	2x4	DRY	No.2
IZ - JA	2x4	DRY	No.2
JA - JB	2x4	DRY	No.2
JB - JC	2x4	DRY	No.2
JC - JD	2x4	DRY	No.2
JD - JE	2x4	DRY	No.2
JE - JF	2x4	DRY	No.2
JF - JG	2x4	DRY	No.2
JG - JH	2x4	DRY	No.2
JH - JI	2x4	DRY	No.2
JI - JJ	2x4	DRY	No.2
JJ - JK	2x4	DRY	No.2
JK - JL	2x4	DRY	No.2
JL - JM	2x4	DRY	No.2
JM - JN	2x4	DRY	No.2
JN - JO	2x4	DRY	No.2
JO - JP	2x4	DRY	No.2
JP - JQ	2x4	DRY	No.2
JQ - JR	2x4	DRY	No.2
JR - JS	2x4	DRY	No.2
JS - JT	2x4	DRY	No.2
JT - JU	2x4	DRY	No.2
JU - JV	2x4	DRY	No.2
JV - JW	2x4	DRY	No.2
JW - JX	2x4	DRY	No.2
JX - JY	2x4	DRY	No.2
JY - JZ	2x4	DRY	No.2
JZ - KA	2x4	DRY	No.2
KA - KB	2x4	DRY	No.2
KB - KC	2x4	DRY	No.2
KC - KD	2x4	DRY	No.2
KD - KE	2x4	DRY	No.2
KE - KF	2x4	DRY	No.2
KF - KG	2x4	DRY	No.2
KG - KH	2x4	DRY	No.2
KH - KI	2x4	DRY	No.2
KI - KJ	2x4	DRY	No.2
KJ - KK	2x4	DRY	No.2
KK - KL	2x4	DRY	No.2
KL - KM	2x4	DRY	No.2
KM - KN	2x4	DRY	No.2
KN - KO	2x4	DRY	No.2
KO - KP	2x4	DRY	No.2
KP - KQ	2x4	DRY	No.2
KQ - KR	2x4	DRY	No.2
KR - KS	2x4	DRY	No.2
KS - KT	2x4	DRY	No.2
KT - KU	2x4	DRY	No.2
KU - KV	2x4	DRY	No.2
KV - KW	2x4	DRY	No.2
KW - KX	2x4	DRY	No.2
KX - KY	2x4	DRY	No.2
KY - KZ	2x4	DRY	No.2
KZ - LA	2x4	DRY	No.2
LA - LB	2x4	DRY	No.2
LB - LC	2x4	DRY	No.2
LC - LD	2x4	DRY	No.2
LD - LE	2x4	DRY	No.2
LE - LF	2x4	DRY	No.2
LF - LG	2x4	DRY	No.2
LG - LH	2x4	DRY	No.2
LH - LI	2x4	DRY	No.2
LI - LJ	2x4	DRY	No.2
LJ - LK	2x4	DRY	No.2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T52	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:20:12 2020 Page 1			
		ID:DMCubINVR6TgFoa31v6l_zns11-XlqxP2MaHZpsUxoIRWd3j86qEbMBWMgKoC9JiwzME7X			
		Scale = 1:22.5			

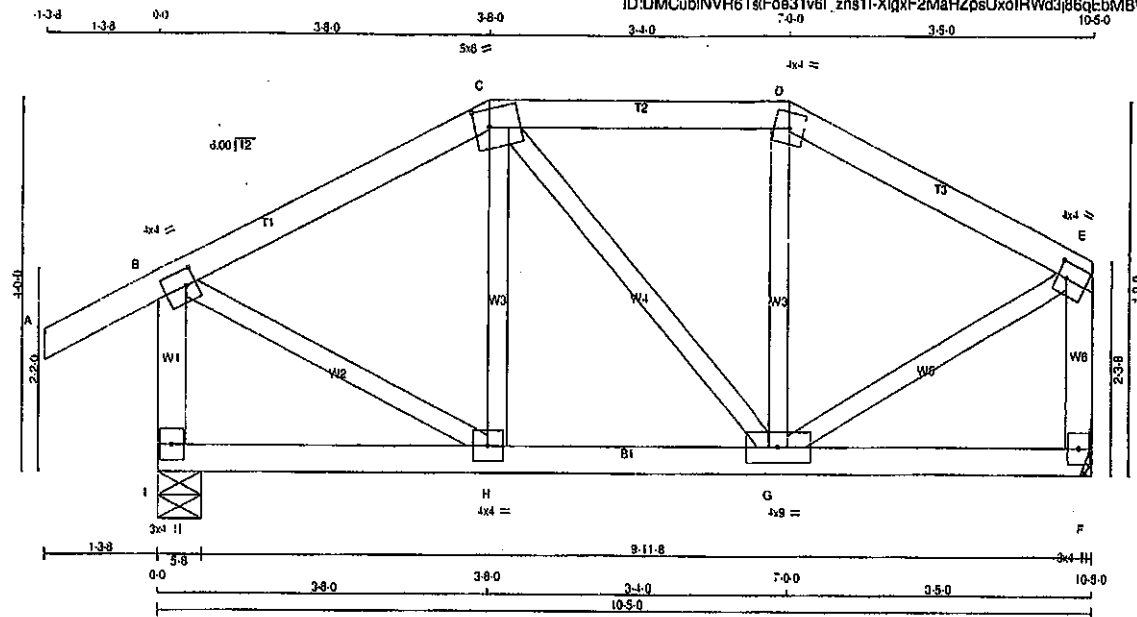

TOTAL WEIGHT = 46 lb
[M/F]

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DESCR.
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
I - F	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMW-1	MT20	4.0	4.0	2.00	1.25
C	TTWW-m	MT20	5.0	6.0	2.25	2.00
D	TTW-m	MT20	4.0	4.0		
E	TMW-1	MT20	4.0	4.0	2.00	1.25
F	BMV1-p	MT20	3.0	4.0		
G	BMWW-1	MT20	4.0	9.0		
H	BMWW-1	MT20	4.0	4.0		
I	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
I	899 0	899 0	5-8	5-8
F	574 0	574 0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	492	338 0	0 0	0 0	0 0	0 0	150 0	0 0
F	406	267 0	0 0	0 0	0 0	0 0	140 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)
FR-TO				FR-TO			
A-B	0 28	-91.8	-91.8 0.12 (1)	10.00	H-C	-116 14	0.03 (1)
B-C	-423 0	-91.8	-91.8 0.16 (1)	6.25	C-G	-20 0	0.01 (1)
C-D	-382 0	-91.8	-91.8 0.13 (1)	6.25	G-D	-126 8	0.03 (1)
D-E	-409 0	-91.8	-91.8 0.14 (1)	6.25	H-E	0 422	0.09 (1)
E-F	-669 0	0.0	0.0 0.08 (1)	7.81	G-E	0 419	0.09 (1)
F-G	-548 0	0.0	0.0 0.07 (1)	7.81			
I-H	0 0	-18.5	-18.5 0.05 (4)	10.00			
H-G	0 375	-18.5	-18.5 0.09 (1)	10.00			
G-F	0 0	-18.5	-18.5 0.05 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

15% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TO=0.16/1.00 (B-C); BC=0.09/1.00 (G-H); WB=0.09/1.00 (B-H); SS=0.12/1.00 (C-D)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.65 (B) INPUT = 0.90
JSI METAL= 0.21 (B) INPUT = 1.00



Structural component only
DWG# T-2007673

JOB NAME 408224	TRUSS NAME T53	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:20:13 2020 Page 1
ID:DMCubiNVR6TstFoe31v6I zns11-7xEJSONC2sxi65NU_E8IGLezS7NHFOFT1svsCMzME7W

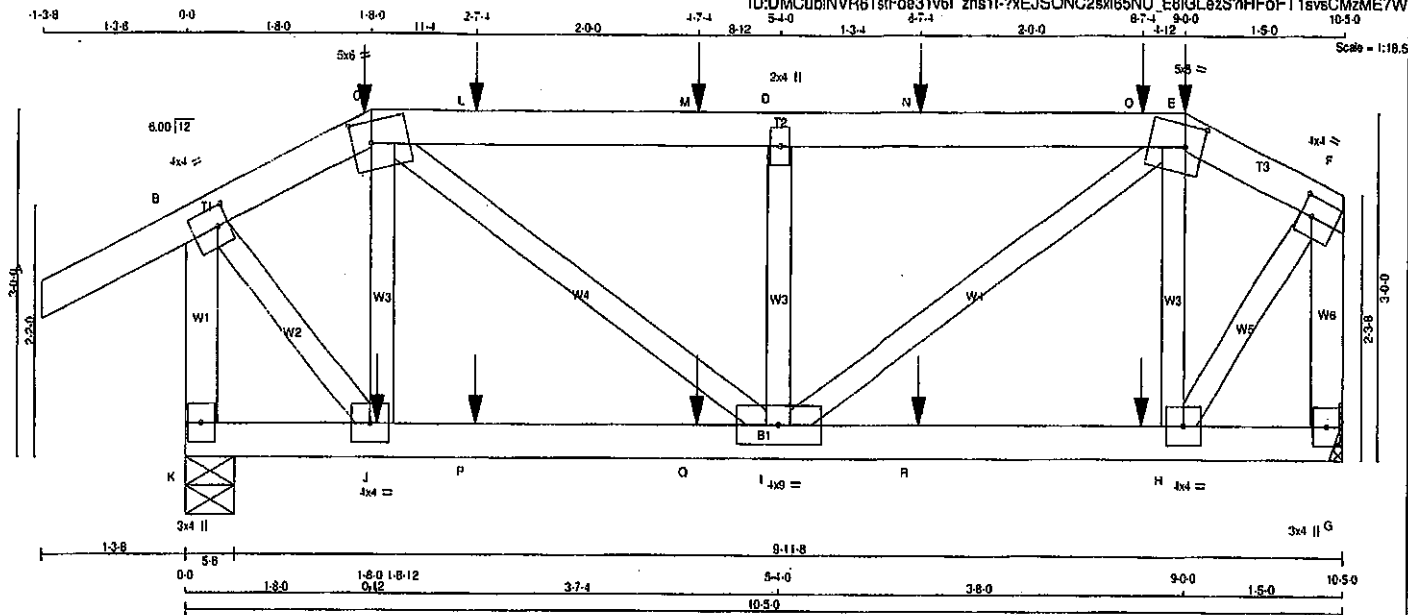


LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DRY
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - N	2x4	DRY	No.2
N - O	2x4	DRY	No.2
O - P	2x4	DRY	No.2
P - Q	2x4	DRY	No.2
Q - R	2x4	DRY	No.2
R - S	2x4	DRY	No.2
S - T	2x4	DRY	No.2
T - U	2x4	DRY	No.2
U - V	2x4	DRY	No.2
V - W	2x4	DRY	No.2
W - X	2x4	DRY	No.2
X - Y	2x4	DRY	No.2
Y - Z	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-t	MT20	4.0	4.0	2.00	1.25
C TTWW-m	MT20	5.0	8.0	2.25	2.00
D TMVW-w	MT20	2.0	4.0		
E TTWW-m	MT20	5.0	6.0	2.25	2.00
F TMVW-t	MT20	4.0	4.0	2.00	1.25
G BMV1-p	MT20	3.0	4.0		
H BMVW-t	MT20	4.0	4.0		
I BMVW-t	MT20	4.0	9.0		
J BMVW-t	MT20	4.0	4.0		
K BMV1-p	MT20	3.0	4.0		

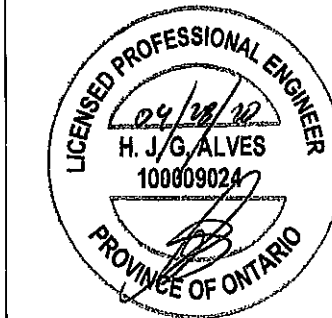

Structural component only
DWG# T-2007674

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	VERT	HORZ	BRG	BRG
K	818	0	818	0	5-8
G	679	0	679	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	576	393	0	0	0	0	183	0
G	480	317	0	0	0	0	162	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO				FR-TO			
A-B	0 28	-91.8	91.8 0.13 (1)	10.00	J-C	-307 0	0.06 (1)
B-C	-427 0	-91.8	91.8 0.13 (1)	6.25	C-I	0 438	0.11 (1)
C-L	-702 0	-91.8	91.8 0.26 (1)	6.25	I-D	-472 0	0.09 (1)
L-M	-702 0	-91.8	91.8 0.26 (1)	6.25	M-E	0 469	0.12 (1)
M-D	-702 0	-91.8	91.8 0.26 (1)	6.25	E-H	-373 0	0.07 (1)
D-N	-702 0	-91.8	91.8 0.26 (1)	6.25	H-F	0 523	0.13 (1)
N-O	-702 0	-91.8	91.8 0.26 (1)	6.25	F-G	0 556	0.14 (1)
O-E	-702 0	-91.8	91.8 0.26 (1)	6.25			
E-F	-379 0	-91.8	91.8 0.04 (1)	8.25			
K-B	-812 0	0.0	0.0 0.10 (1)	7.81			
G-F	-677 0	0.0	0.0 0.09 (1)	7.81			
K-J	0 0	-18.5	-18.5 0.04 (4)	10.00			
J-P	0 349	-18.5	-18.5 0.09 (1)	10.00			
P-Q	0 349	-18.5	-18.5 0.09 (1)	10.00			
Q-I	0 349	-18.5	-18.5 0.09 (1)	10.00			
I-R	0 324	-18.5	-18.5 0.09 (1)	10.00			
R-H	0 324	-18.5	-18.5 0.09 (1)	10.00			
H-G	0 0	-18.5	-18.5 0.04 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	1-8.0	-53	-53	---	BACK	VERT	TOTAL	---
E	9-0.0	-21	-21	---	FRONT	VERT	TOTAL	---
H	8-7.4	-4	-4	---	BACK	VERT	TOTAL	---
J	1-8.12	-4	-4	---	BACK	VERT	TOTAL	---
L	2-7.4	-28	-28	---	BACK	VERT	TOTAL	---
M	4-7.4	-25	-25	---	BACK	VERT	TOTAL	---
N	6-7.4	-25	-25	---	BACK	VERT	TOTAL	---
O	8-7.4	-53	-53	---	BACK	VERT	TOTAL	---
P	2-7.4	-4	-4	---	BACK	VERT	TOTAL	---
Q	4-7.4	-4	-4	---	BACK	VERT	TOTAL	---
R	6-7.4	-4	-4	---	BACK	VERT	TOTAL	---

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDTL. USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS DESIGN IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/988 (0.02")

CSI: TC=0.26(1.00) (0-E:1), BC=0.09(1.00) (J-J:1), WB=0.14(1.00) (F-H:1), SS=0.21(1.00) (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 616 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.77 (F) (INPUT = 0.90)
JSI METAL = 0.22 (F) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ORWG NO.
408224	T54S	1	2	GREEN PARK HOMES	
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:20:14 2020 Page 1
ID:DMCubINVR6TslFoe31v6l zns1l-T7ohgkOqpA3ZkEygYxgXoZB2uPsf_43dQWeQkpzME7V

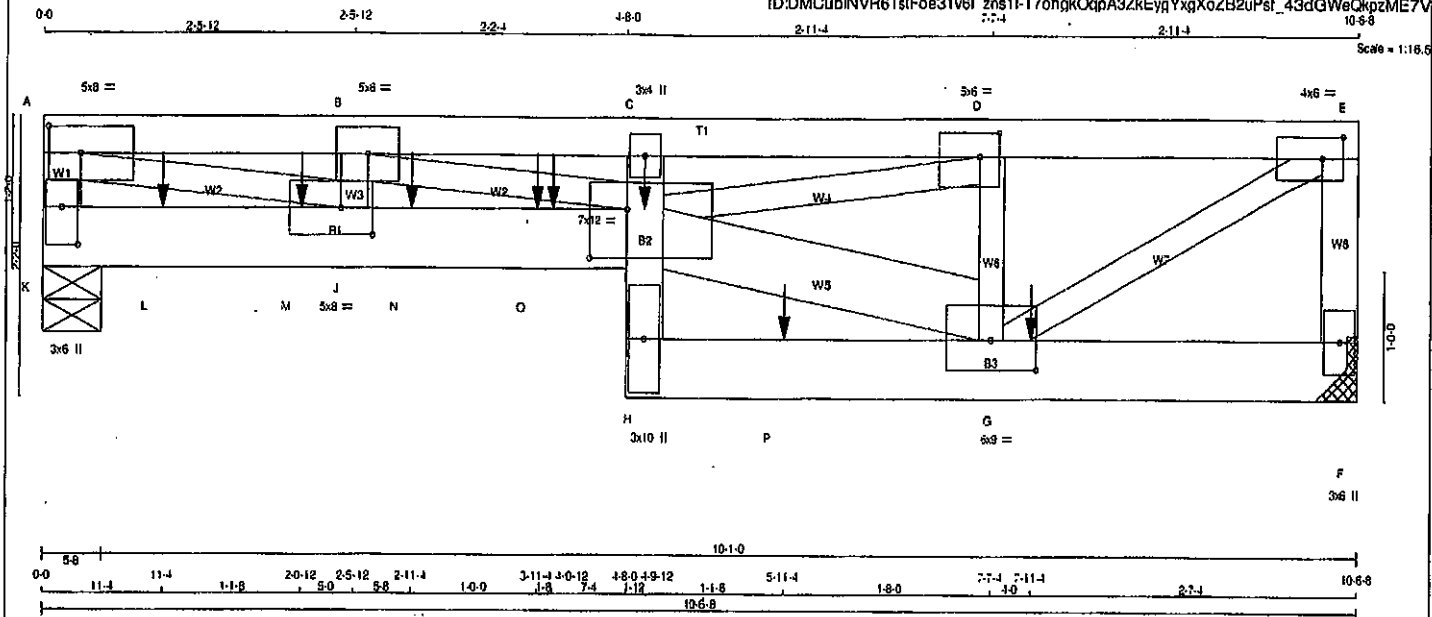

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
K - A	2x4	DRY	No.2
A - E	2x4	DRY	No.2
F - E	2x4	DRY	No.2
K - I	2x6	DRY	No.2
H - C	2x4	DRY	No.2
H - F	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
I - G	2x6	DRY	No.2

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
K - A	12	TOP
A - E	12	TOP
E - F	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
K - I	12	SIDE(81.0)
H - F	12	SIDE(183.1)
C - H	5	SIDE(89.6)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	
2x6	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	DOWN	UP	BRG
K	2804	0	2804	0	5-8
F	2255	0	2255	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 4.0.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
K	1841	1212	0	0	0	628	0
F	1592	1081	0	0	0	531	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.36 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED	FACTORED	MAX.	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX (PLF)	CSI (LC)	MEMB.	FORCE (LBS)
FR-TO					FR-TO	
K-A	-2274	0.0	0.0	0.13 (1)	I-G	0 2886
A-B	-6694	-91.8	-91.8	0.22 (1)	I-D	0 5928
B-C	-10298	-91.8	-91.8	0.68 (1)	G-D	-2146 0
C-D	-9247	-91.8	-91.8	0.61 (1)	G-E	0 4043
D-E	-3416	-91.8	-91.8	0.16 (1)	J-B	-1577 0
F-E	-2242	0.0	0.0	0.13 (1)	A-J	0 7027
					B-I	0 3806
K-L	0 0	-18.5	-18.5	0.21 (1)		
L-M	0 0	-18.5	-18.5	0.21 (1)		
M-J	0 0	-18.5	-18.5	0.21 (1)		
J-N	0 6694	-18.5	-18.5	0.79 (1)		
N-O	0 6694	-18.5	-18.5	0.79 (1)		
O-I	0 6694	-18.5	-18.5	0.79 (1)		
H-I	0 354	0.0	0.0	0.65 (1)		
I-C	0 128	0.0	0.0	0.63 (1)		
H-P	0 832	-18.5	-18.5	0.20 (1)		
P-G	0 832	-18.5	-18.5	0.20 (1)		
G-F	0 0	-18.5	-18.5	0.01 (4)		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
G	7-11-4	-681	-681	---	BACK	VERT	TOTAL	C1
I	4-9-12	-577	-577	---	FRONT	VERT	TOTAL	C1
L	11-4	-72	-72	---	BACK	VERT	TOTAL	C1
M	2-0-12	-352	-352	---	FRONT	VERT	TOTAL	C1
N	2-11-4	-142	-142	---	BACK	VERT	TOTAL	C1
O	3-11-4	-983	-983	---	BACK	VERT	TOTAL	C1
O	4-0-12	-354	-354	---	FRONT	VERT	TOTAL	C1
P	5-11-4	-556	-556	---	BACK	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/882 (0.15")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/489 (0.27")

CSI: TC=0.66/1.00 (B-C:1), BC=0.79/1.00 (I-J:1), WB=0.87/1.00 (A-J:1), SSI=0.45/1.00 (C-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.88 (E) INPUT = 0.90
JSI METAL= 0.73 (D) INPUT = 1.00



Structural component only
DWG# T-2007675 1/2

CONTINUED ON PAGE 2


JOB NAME 408224	TRUSS NAME T54S	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:20:14 2020 Page 2
ID:DMCubINVR6TslFoe31v6l znsll-T7ohqkOqpA3ZkEvgYxqXoZB2uPsl 43dGWeQkqzME7V


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWW-I	MT20	5.0	8.0	2.50	3.00
B	TMWW-I	MT20	5.0	6.0		
C	TMV+p	MT20	3.0	4.0		
D	TMWW-I	MT20	5.0	6.0	2.25	2.00
E	TMWW-I	MT20	4.0	6.0	2.00	2.00
F	BMV1+p	MT20	3.0	8.0		
G	BMWWW-I	MT20	6.0	9.0	2.75	4.50
H	BMV+p	MT20	3.0	10.0		
I	BMWWWW-I	MT20	7.0	12.0	4.50	3.75
J	BMWW-I	MT20	5.0	8.0	2.50	3.00
K	BMV1+p	MT20	3.0	6.0	3.50	1.50

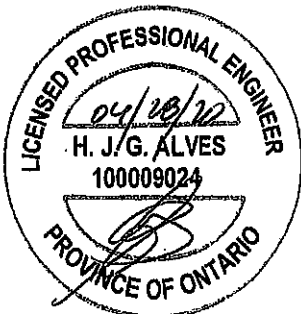

Structural component only
DWG# T-2007675 *HL*

JOB NAME 408222	TRUSS NAME V1	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

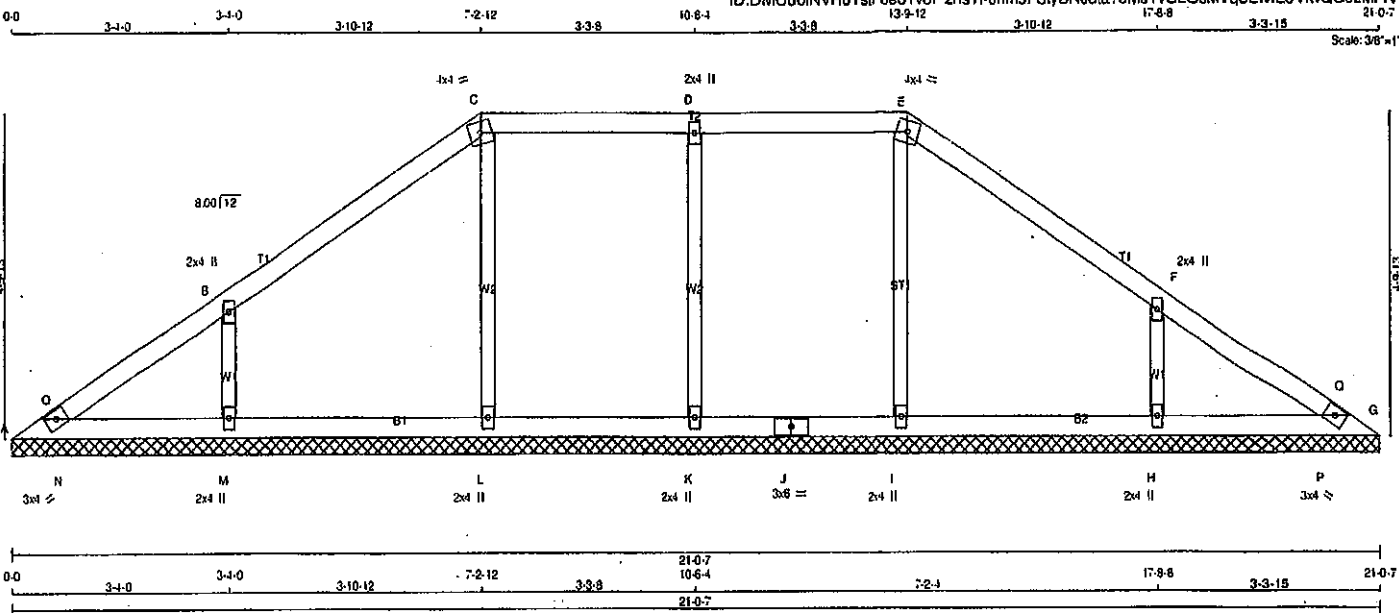

TOTAL WEIGHT = 63 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
A - J	2x4	DRY	No.2
J - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)	PLATES	W	LEN	Y	X
JT TYPE	MT20	3.0	4.0		
A TBM-h	MT20	3.0	4.0		
B, D, F					
B TMW+w	MT20	2.0	4.0		
C TTW-m	MT20	4.0	4.0		
E TTW-m	MT20	4.0	4.0		
G TBM-h	MT20	3.0	4.0		
H, I, K, L, M					
H BMW+w	MT20	2.0	4.0		
J BS-1	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	VERT	GROSS REACTION	HORIZ	DOWN	HORIZ	BRG	BRG	IN-SX	IN-SX
A	128	0	128	0	0	21-0.7 (11-11220-7			
G	128	0	128	0	0	21-0.7 (11-11220-7			
I	330	0	330	0	0	21-0.7 (11-11220-7			
L	330	0	330	0	0	21-0.7 (11-11220-7			
K	433	0	433	0	0	21-0.7 (11-11220-7			
H	485	0	485	0	0	21-0.7 (11-11220-7			
M	485	0	485	0	0	21-0.7 (11-11220-7			

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	PERM. LIVE	WIND	DEAD	SOIL
A	90	81	0	0	0	0	0	29	0	0	0
G	90	81	0	0	0	0	0	29	0	0	0
I	235	143	0	0	0	0	0	93	0	0	0
L	235	143	0	0	0	0	0	93	0	0	0
K	304	212	0	0	0	0	0	92	0	0	0
H	342	228	0	0	0	0	0	114	0	0	0
M	342	228	0	0	0	0	0	114	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, G, I, L, K, H, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	CS (I/C)	MEMB.	FORCE (LBS)	MAX. CS (I/C)	MAX. CS (I/C)
FR-TO		FROM TO		FR-TO			
A-O	23 2	-91.8 -91.8 0.04 (1)	6.25	I-E	-266 0	0.09 (1)	0.09 (1)
O-B	0 33	-91.8 -91.8 0.21 (1)	10.00	L-C	-288 0	0.13 (1)	0.13 (1)
B-C	-8 8	-91.8 -91.8 0.20 (1)	10.00	K-D	-377 0	0.06 (1)	0.06 (1)
C-D	0 17	-91.8 -91.8 0.17 (1)	10.00	H-F	-393 0	0.06 (1)	0.06 (1)
D-E	0 17	-91.8 -91.8 0.17 (1)	10.00	M-B	-393 0	0.06 (1)	0.06 (1)
E-F	-8 8	-91.8 -91.8 0.20 (1)	10.00	N-O	-39 5	0.00 (1)	0.00 (1)
F-Q	0 33	-91.8 -91.8 0.21 (1)	10.00	P-Q	-39 5	0.00 (1)	0.00 (1)
Q-G	-23 2	-91.8 -91.8 0.04 (1)	6.25				
A-N	-9 0	-18.5 -18.5 0.05 (1)	10.00				
N-M	-7 7	-18.5 -18.5 0.06 (4)	10.00				
M-L	-11 0	-18.5 -18.5 0.06 (4)	6.25				
L-K	-17 0	-18.5 -18.5 0.05 (4)	6.25				
K-J	-17 0	-18.5 -18.5 0.05 (4)	6.25				
J-I	-17 0	-18.5 -18.5 0.05 (4)	6.25				
I-H	-11 0	-18.5 -18.5 0.06 (4)	6.25				
H-P	-7 7	-18.5 -18.5 0.06 (4)	10.00				
P-G	-9 0	-18.5 -18.5 0.05 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.21 (1.00 (B-C:1), BC=0.06 (1.00 (L-M:4), WB=0.13 (1.00 (D-K:1), SS=0.15 (1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 786 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.61 (C) INPUT = 0.90
JSI METAL= 0.20 (F) INPUT = 1.00




Structural component only
DWG# T-2007616

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	V2	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:00:15 2020 Page 1

ID:DMCubINVR6TsFoe31v6I zns11-UKTTnJa hRUUKaLwZ38oYw1qu824qFkOezoTzMFIL

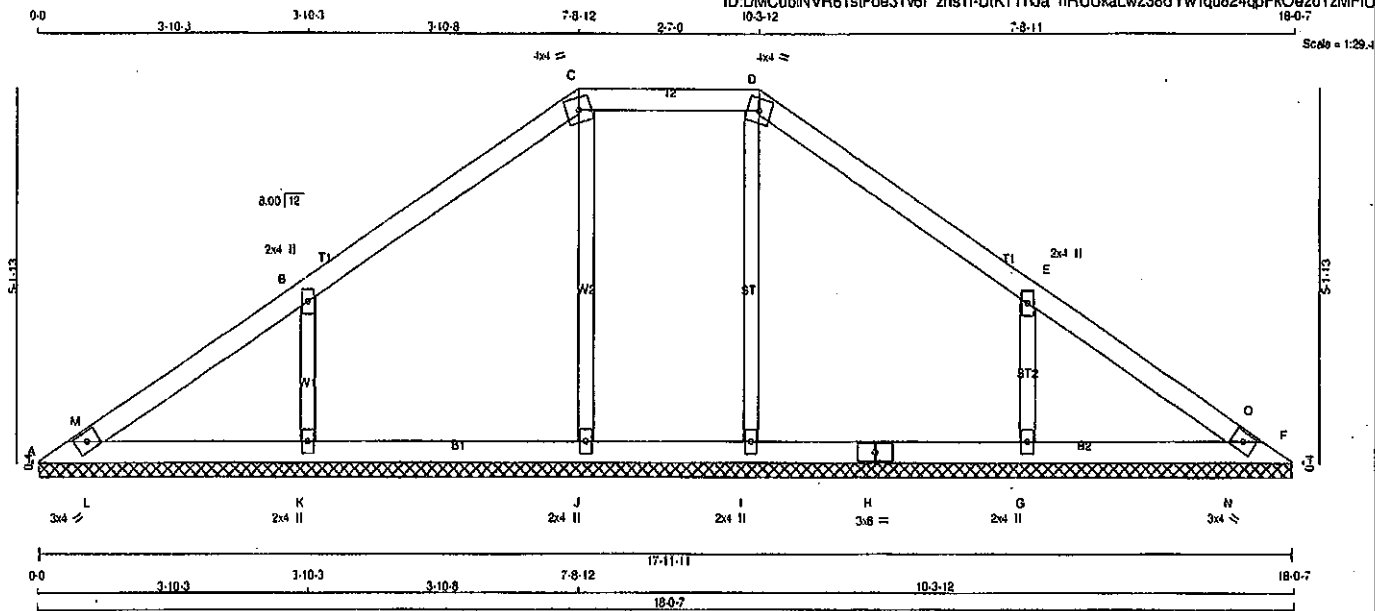

TOTAL WEIGHT = 54 lb

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR.
A - C	2x4	DRY	No.2		SPF
C - D	2x4	DRY	No.2		SPF
D - F	2x4	DRY	No.2		SPF
A - H	2x4	DRY	No.2		SPF
H - F	2x4	DRY	No.2		SPF
ALL WEBS		2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.					

PLATES (tablets in inches)	W	LEN	Y	X
JT TYPE				
A TBM1-h	MT20	3.0	4.0	
B TMW+w	MT20	2.0	4.0	
C TTW-m	MT20	4.0	4.0	
D TTW-m	MT20	4.0	4.0	
E TMW+w	MT20	2.0	4.0	
F TBM1-h	MT20	3.0	4.0	
G, I, J, K				
G BMW1+w	MT20	2.0	4.0	
H BS-4	MT20	3.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	UPLIFT
A	138	0	138	0
F	135	0	135	0
I	344	0	344	0
G	513	0	513	0
J	342	0	342	0
K	513	0	513	0

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST LOASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
	COMBINED							
A	96	65	0	0	0	0	30	0
F	95	65	0	0	0	0	30	0
I	244	155	0	0	0	0	89	0
G	362	240	0	0	0	0	122	0
J	342	154	0	0	0	0	88	0
K	362	240	0	0	0	0	122	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, F, I, G, J, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)	MAX. FACTORED LENGTH (FT)	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)
FR-TO						FR-TO			
A-M	0	20	-91.8	-91.8	0.04 (1)	10.00	I-D	-292	0
M-B	0	71	-91.8	-91.8	0.22 (1)	10.00	G-E	-408	0
B-C	0	33	-91.8	-91.8	0.22 (1)	10.00	J-C	-291	0
C-D	0	52	-91.8	-91.8	0.11 (1)	10.00	K-B	-408	0
D-E	0	33	-91.8	-91.8	0.22 (1)	10.00	L-M	-71	4
E-O	0	71	-91.8	-91.8	0.22 (1)	10.00	N-O	-89	5
O-F	0	19	-91.8	-91.8	0.04 (1)	10.00			

A-L	-43	0	-18.5	-18.5	0.07 (1)	6.25
L-K	-30	0	-18.5	-18.5	0.07 (1)	6.25
K-J	-45	0	-18.5	-18.5	0.07 (4)	6.25
J-I	-52	0	-18.5	-18.5	0.04 (4)	6.25
I-H	-45	0	-18.5	-18.5	0.07 (4)	6.25
H-G	-45	0	-18.5	-18.5	0.07 (4)	6.25
G-N	-30	0	-18.5	-18.5	0.07 (1)	6.25
N-F	-43	0	-18.5	-18.5	0.07 (1)	6.25

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.22:1.00 (E-O:1), BC=0.07:1.00 (K-L:1), WB=0.11 1.00 (D-I:1), SL=0.14:1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1997 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.61 (C) (INPUT = 0.90)
JSI METAL = 0.21 (E) (INPUT = 1.00)




Structural component only
DWG# T-2007617

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	V3	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:16 2020 Page 1
ID:DMCubINVR6TsFoa31v8l_zns1l-y4lrg7JCl_ZL6u9XTGaNLmTCiIVXpH4Qy2OWKvzMfIT

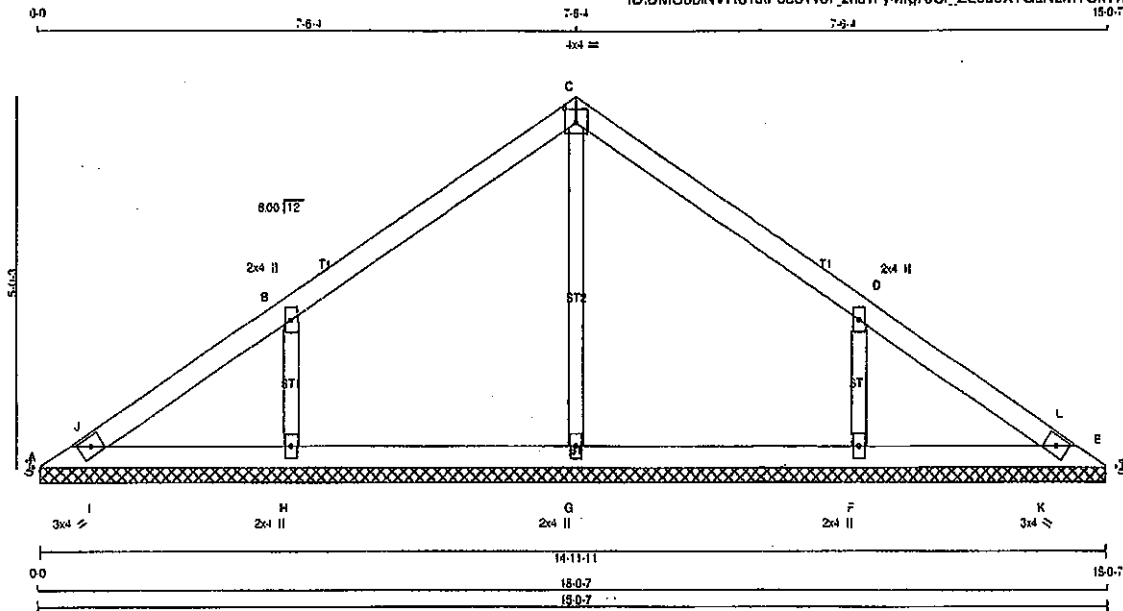

Scale = 1:28.8

TOTAL WEIGHT = 43 lb

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	SPF	
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
A - E	2x4	DRY	No.2	SPF	
ALL WEBS 2x3 DRY				No.2	SPF
DRY: SEASONED LUMBER.					

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
A - TBM1-h	MT20	3.0	4.0		
B - TMW+w	MT20	2.0	4.0		
C - TTW-p	MT20	4.0	4.0	2.25	2.00
D - TMW+w	MT20	2.0	4.0		
E - TBM1-h	MT20	3.0	4.0		
F, G, H					
F - BMW1+w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	HORZ	GROSS REACTION	DOWN	HORZ	BRG	IN-SX	BRG	IN-SX
A	134	0	134	0	0	14-11-11	14-11-11		
E	134	0	134	0	0	14-11-11	14-11-11		
G	381	0	381	0	0	14-11-11	14-11-11		
H	501	0	501	0	0	14-11-11	14-11-11		
F	501	0	501	0	0	14-11-11	14-11-11		

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	95	65 0	0 0	0 0	0 0	30 0	0 0
E	95	65 0	0 0	0 0	0 0	30 0	0 0
G	272	182 0	0 0	0 0	0 0	110 0	0 0
H	353	237 0	0 0	0 0	0 0	116 0	0 0
F	353	237 0	0 0	0 0	0 0	116 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, G, H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO	LENGTH FR-TO	FR-TO			
A-J	-20 4	-91.8 -91.8 0.04 (1)	6.25	G-C	-316 0	0.11 (1)	
J-B	0 38	-91.8 -91.8 0.22 (1)	10.00	H-B	-408 0	0.08 (1)	
B-C	-5 12	-91.8 -91.8 0.21 (1)	10.00	F-D	-408 0	0.08 (1)	
C-D	-5 12	-91.8 -91.8 0.21 (1)	10.00	I-J	-46 6	0.00 (1)	
D-L	0 36	-91.8 -91.8 0.22 (1)	10.00	K-L	-46 6	0.00 (1)	
L-E	-20 4	-91.8 -91.8 0.04 (1)	8.25				
A-I	-13 0	-18.5 -18.5 0.06 (1)	8.25				
I-H	-10 3	-18.5 -18.5 0.06 (4)	8.25				
H-G	-13 0	-18.5 -18.5 0.06 (4)	8.25				
G-F	-13 0	-18.5 -18.5 0.06 (4)	8.25				
F-K	-10 3	-18.5 -18.5 0.06 (4)	8.25				
K-E	-13 0	-18.5 -18.5 0.06 (1)	6.25				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.22/1.00 (B-J:1), BC=0.08/1.00 (G-H:4), WB=0.11/1.00 (C-G:1), SI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1887 1886

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.28 (D) (INPUT = 0.90)
JSI METAL = 0.21 (D) (INPUT = 1.00)

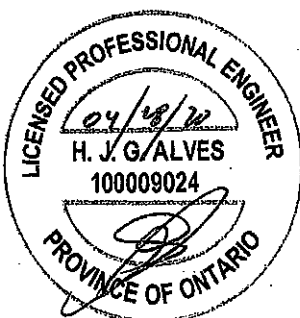


Structural component only
DWG# T-2007618

JOB NAME 408222	TRUSS NAME V4	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 6.310 8 Oct 20 2018 MTEK Industries, Inc. Tue Apr 28 11:37:42 2020 Page 1

ID:DMCubINVR6TsFoe31v8I_zns1I-NKeqA2eMCGf4MYH_q82VAKhU92Pb0QNm3fZNSpZMD_

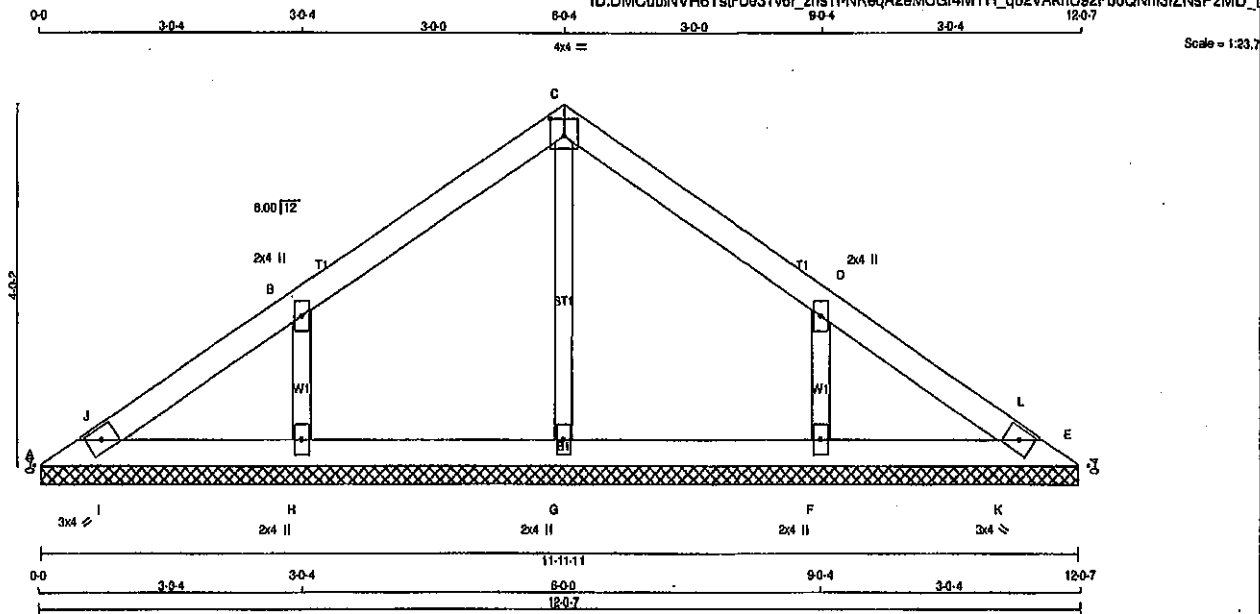

TOTAL WEIGHT = 34 lb

LUMBER			
N.L.G.A. RULES	CHORDS	SIZE	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
A - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)			
JT TYPE	PLATES	W	LEN Y X
A TBM1-h	MT20	3.0	4.0
B TMW+w	MT20	2.0	4.0
C TTW-p	MT20	4.0	4.0 2.25 2.00
D TMW+w	MT20	2.0	4.0
E TBM1-h	MT20	3.0	4.0
F, G, H			
F BMW1+w	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORZ	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
A	117	0	117	0	11-11-11	11-11-11
E	117	0	117	0	11-11-11	11-11-11
G	290	0	290	0	11-11-11	11-11-11
F	398	0	398	0	11-11-11	11-11-11
H	398	0	398	0	11-11-11	11-11-11

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	83	58/0	0/0	0/0	26/0	0/0	0/0
E	83	58/0	0/0	0/0	26/0	0/0	0/0
G	207	125/0	0/0	0/0	82/0	0/0	0/0
F	281	188/0	0/0	0/0	93/0	0/0	0/0
H	281	188/0	0/0	0/0	93/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, G, F, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO		FR-TO			
A-J	-8/5	-91.8 -91.8	0.03 (1)	G-C	-248/0	0.08 (1)	
J-B	0/38	-91.8 -91.8	0.13 (1)	F-D	-314/0	0.05 (1)	
B-C	0/12	-91.8 -91.8	0.13 (1)	H-B	-314/0	0.05 (1)	
C-D	0/12	-91.8 -91.8	0.13 (1)	I-J	-47/4	0.00 (1)	
D-L	0/36	-91.8 -91.8	0.13 (1)	K-L	-47/4	0.00 (1)	
L-E	-8/5	-91.8 -91.8	0.03 (1)				
A-I	-13/0	-18.5 -18.5	0.05 (1)				
I-H	-10/0	-18.5 -18.5	0.05 (1)				
H-G	-20/0	-18.5 -18.5	0.04 (4)				
G-F	-20/0	-18.5 -18.5	0.04 (4)				
F-K	-10/0	-18.5 -18.5	0.05 (1)				
K-E	-13/0	-18.5 -18.5	0.05 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(85% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TO=0.13/1.00 (B-J:1), BC=0.05/1.00 (A-I:1), WB=0.08/1.00 (G-G:1), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1867 788 1867 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.22 (D) (INPUT = 0.90)
JSI METAL= 0.16 (B) (INPUT = 1.00)

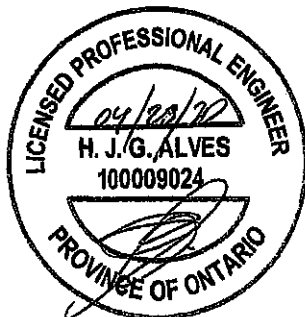

Structural component only
DWG# T-2007619

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Tue Apr 28 09:00:17 2020 Page 1
ID:DMCubINVR6TstF0e31v6I_zns1I-QGREITKqWlnCk2kk1_6otz?N9lp5YjBYB74tl.zMFIS



DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
<u>BEARINGS</u>							
JT	FACTORED		MAXIMUM FACTORED		INPUT BRG	REQD BRG	
	GROSS VERT	REACTION HORZ	GROSS VERT	REACTION HORZ			
	49	0	49	0	8-11-11	8-11-11	
C	49	0	49	0	8-11-11	8-11-11	
D	893	0	893	0	8-11-11	8-11-11	

UNFACTORED REACTIONS		MAX. MIN. COMPONENT REACTIONS					
JT	1ST LGASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	34	22.0	0.0	0.0	0.0	12.0	0.0
C	34	22.0	0.0	0.0	0.0	12.0	0.0
D	631	415.0	0.0	0.0	0.0	216.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C, D

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. CS1 (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)		
FR-TO		FROM TO		LENGTH	FR-TO				
A-F	0 347	-91.8 -91.8	0.12 (1)	10.00	D-B	-898 0	0.12 (1)		
F-B	0 341	-91.8 -91.8	0.23 (1)	10.00	E-F	-225 0	0.00 (1)		
B-H	0 341	-91.8 -91.8	0.23 (1)	10.00	G-H	-225 0	0.00 (1)		
H-C	0 347	-91.8 -91.8	0.12 (1)	10.00					
A-E	-321 0	-18.5 -18.5	0.18 (1)	8.25					
E-D	-290 0	-18.5 -18.5	0.17 (1)	8.25					
D-G	-290 0	-18.5 -18.5	0.17 (1)	8.25					
G-C	-321 0	-18.5 -18.5	0.16 (1)	8.25					

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6 PSF
	DL =	8.0 PSF
BOT CH.	LL =	0.0 PSF
	DL =	7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 240 IN.C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLES WITH:

- PART 9 OF BCBC 2018, CBC 2012 , ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.23/1.00 (B-F:1), BC=0.17/1.00 (D-E:1),
WB=0.12/1.00 (B-C:1), SS=0.12/1.00 (A-E:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10
COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)		SHEAR		SECTION
	(PSI)		(PLI)		(PLI)
	MAX	MIN	MAX	MIN	MAX MIN
MY20	618	354	1667	788	1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.59 (B) (INPUT = 0.90)
JSI METAL= 0.20 (B) (INPUT = 1.00)

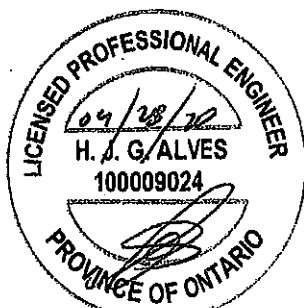


Structural component only
DWG# T-2007620

Structural component only
DWG# T-2007600

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	PB2	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:00:03 2020 Page 1

ID:DMCubINVR6TslFoe31v6l_zns1l-qabxxh92p?wB2u12D2sKJ0Q?w31_GPEUzWkKN9zMFip

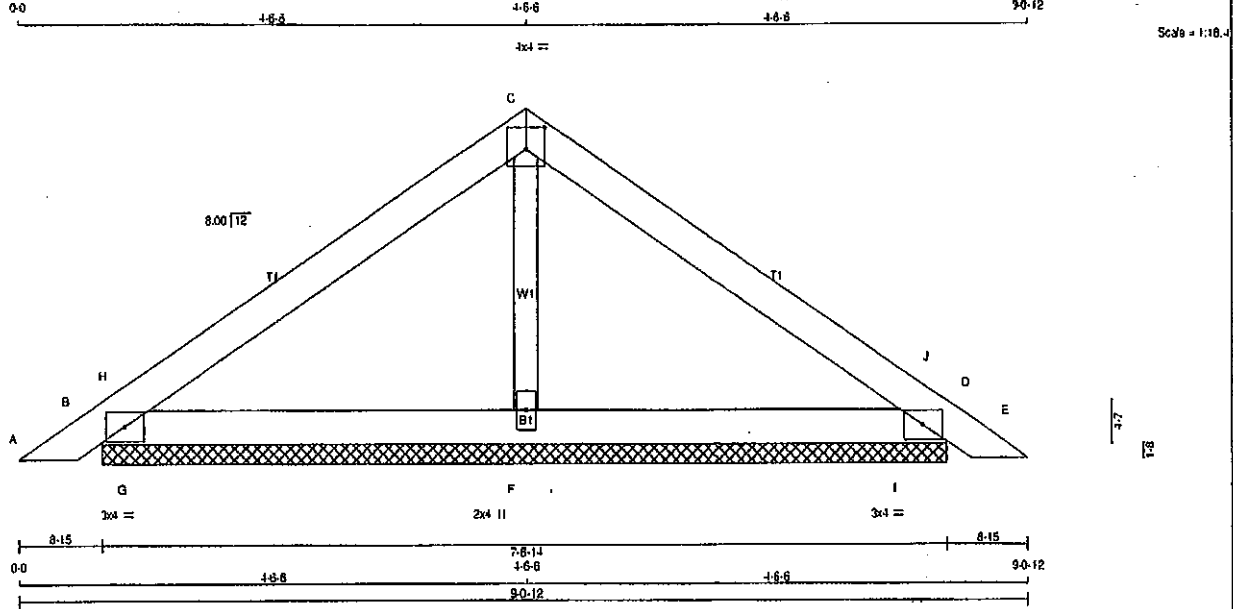

TOTAL WEIGHT = 2 X 23 = 46 lb

LUMBER	N.L.G.A. RULES	CHOROS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
B - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table in inches)	W	LEN	Y	X
JT TYPE	PLATES			
B	TMB1-I	MT20	3.0	4.0
C	TTW-p	MT20	4.0	4.0
D	TMB1-I	MT20	3.0	4.0
F	BMW1-w	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UPLIFT
B	318	0	318	0
D	318	0	318	0
F	320	0	320	0

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
JT	SNOW	LIVE	PERM. LIVE	
B	223	159	0	0
D	223	159	0	0
F	229	137	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSF (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSF (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 15	-91.8 -91.8	0.03 (1)	10.00	F-C	-148 0	
B-H	-31 0	-91.8 -91.8	0.07 (1)	6.25	G-H	-349 0	
H-C	-135 0	-91.8 -91.8	0.16 (1)	6.25	I-J	-349 0	
C-J	-135 0	-91.8 -91.8	0.16 (1)	6.25			
J-D	-31 0	-91.8 -91.8	0.07 (1)	6.25			
D-E	0 15	-91.8 -91.8	0.03 (1)	10.00			
B-G	0 105	-18.5 -18.5	0.15 (1)	10.00			
G-F	0 105	-18.5 -18.5	0.15 (1)	10.00			
F-I	0 105	-18.5 -18.5	0.15 (1)	10.00			
I-D	0 105	-18.5 -18.5	0.15 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. O.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.16 1.00 (C-J:1), BC=0.15 1.00 (F-I:1), WB=0.03 1.00 (C-F:1), SS=0.26 1.00 (D-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 616 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.28 (D) INPUT = 0.90
JSI METAL = 0.07 (D) INPUT = 1.00




Structural component only
DWG# T-2007601

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	ORWG NO.
408223	PB20	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:03:58 2020 Page 1
ID:DMCubINVR6TstF0e31v6l zns11-6 jzPKYM7hrKOx8JFY7B9Jg2AAAFery9gNMkIPVzMEMn

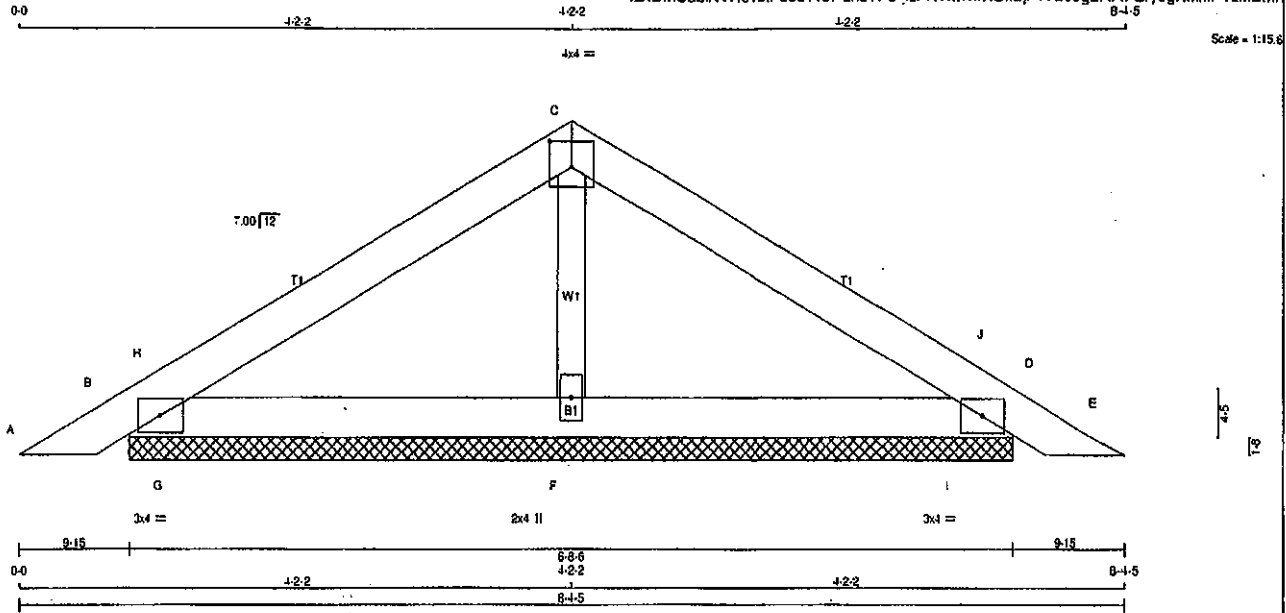

TOTAL WEIGHT = 4 X 20 = 80 lb

LUMBER					DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER		SPF	
A - C	2x4	DRY	No.2		SPF	
C - E	2x4	DRY	No.2		SPF	
B - D	2x4	DRY	No.2		SPF	
ALL WEBS 2x3 DRY					SPF	
DRY: SEASONED LUMBER.						

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMB1-I	MT20	3.0	4.0	
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TMB1-I	MT20	3.0	4.0	
F	BMV1+w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BRG	BRG
B	281	0	281	0	0	6-8-6	6-8-6		
D	281	0	281	0	0	6-8-6	6-8-6		
F	314	0	314	0	0	6-8-6	6-8-6		

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
B	197	141	0	0	0	55	0	0
D	197	141	0	0	0	55	0	0
F	224	137	0	0	0	87	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 16	-91.8 -91.8	0.04 (1)	10.00	F-C	-159 0	0.02 (1)
B-H	-44 0	-91.8 -91.8	0.05 (1)	6.25	G-H	-250 0	0.00 (1)
H-C	-39 0	-91.8 -91.8	0.12 (1)	6.25	I-J	-250 0	0.00 (1)
C-J	-39 0	-91.8 -91.8	0.12 (1)	6.25			
J-D	-44 0	-91.8 -91.8	0.05 (1)	6.25			
D-E	0 16	-91.8 -91.8	0.04 (1)	10.00			
B-G	0 81	-18.5 -18.5	0.12 (1)	10.00			
G-F	0 81	-18.5 -18.5	0.12 (1)	10.00			
F-I	0 81	-18.5 -18.5	0.12 (1)	10.00			
I-D	0 81	-18.5 -18.5	0.12 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.8	PSF
	DL	= 6.0	PSF
BDT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (CH:1), BC=0.12/1.00 (B-G:1), WB=0.02/1.00 (C-F:1), SI=0.18/1.00 (D-I:1)

DDL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1887 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (D) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)

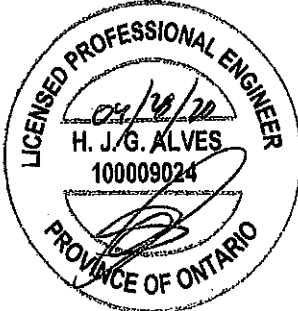

Structural component only
DWG# T-2007627

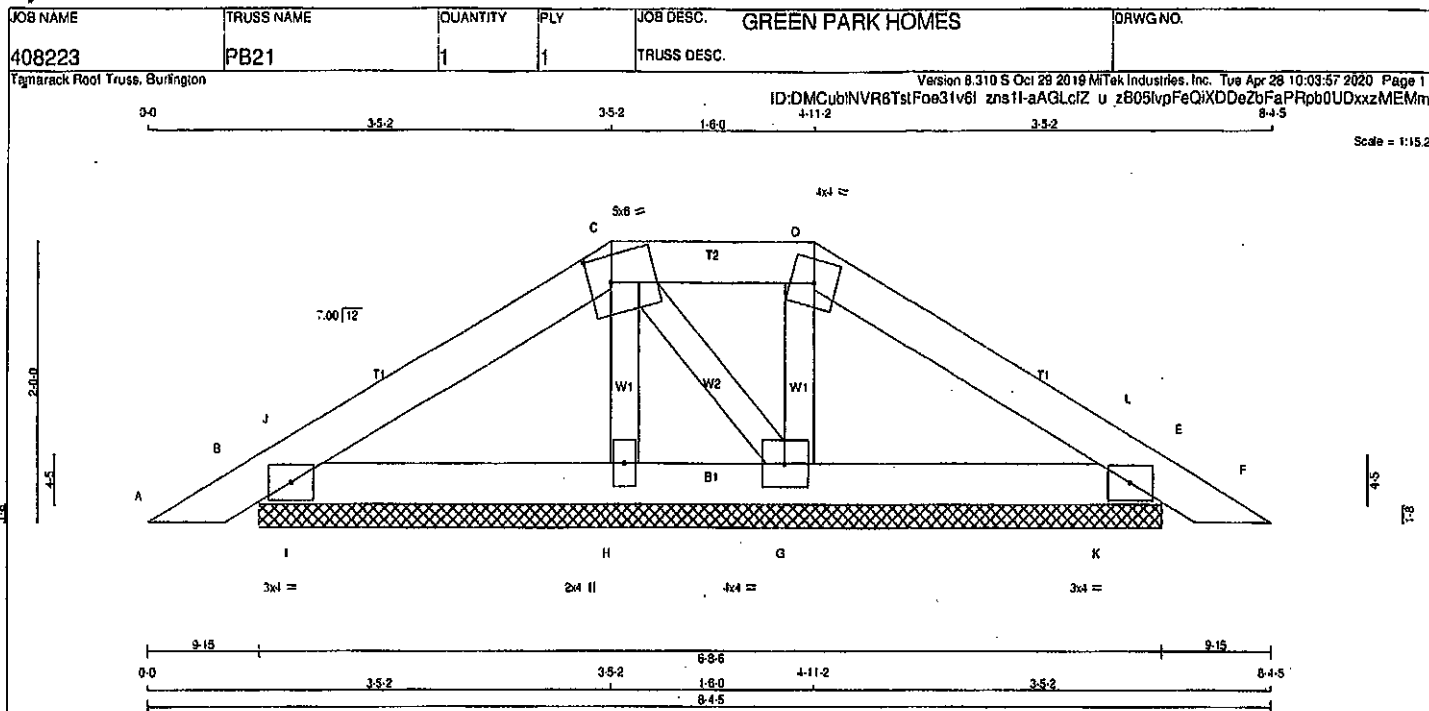

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
B - E	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-t	MT20	3.0	4.0		
C	TTW-m	MT20	5.0	6.0	2.25	2.00
D	TTW-m	MT20	4.0	4.0		
E	TMB1-t	MT20	3.0	4.0		
G	BMW1-t	MT20	4.0	4.0		
H	BMW1-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REGRD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
B	241	0	241	0	6-8-6	6-8-6
E	228	0	228	0	6-8-6	6-8-6
H	170	0	170	0	6-8-6	6-8-6
G	238	0	238	0	6-8-6	6-8-6

UNFACTORED REACTIONS

JT	1ST CASE		MAX MIN COMPONENT REACTIONS		WIND	DEAD	SOIL
	SNOW	LIVE	PER	LIVE			
B	189	121.0	0.0	0.0	0.0	48.0	0.0
E	160	114.0	0.0	0.0	0.0	46.0	0.0
H	122	74.0	0.0	0.0	0.0	48.0	0.0
G	188	111.0	0.0	0.0	0.0	57.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS (LC)	MAX. FACTORED UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)
FR-TO					FR-TO		
A-B	0 16	-91.8	-91.8 0.04 (1)	10.00	H-C	-107 0	0.02 (1)
B-J	-59 0	-91.8	-91.8 0.01 (1)	0.25	C-G	-35 0	0.01 (1)
J-C	-71 0	-91.8	-91.8 0.07 (1)	6.25	G-D	-147 0	0.02 (1)
C-D	-28 0	-91.8	-91.8 0.04 (1)	6.25	I-J	-139 0	0.09 (1)
D-L	-46 0	-91.8	-91.8 0.07 (1)	6.25	K-L	-141 0	0.09 (1)
L-E	-33 0	-91.8	-91.8 0.01 (1)	6.25			
E-F	0 16	-91.8	-91.8 0.04 (1)	10.00			
B-I	0 59	-18.5	-18.5 0.07 (1)	10.00			
I-H	0 59	-18.5	-18.5 0.07 (1)	10.00			
H-G	0 52	-18.5	-18.5 0.04 (1)	10.00			
G-K	0 38	-18.5	-18.5 0.07 (1)	10.00			
K-E	0 38	-18.5	-18.5 0.07 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.07 1.00 (D-L:1), BC=0.07 1.00 (B-L:1), WB=0.02 1.00 (D-G:1), SS=0.11 1.00 (E-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.19 (B) INPUT = 0.90)
JSI METAL= 0.05 (D) INPUT = 1.00)




Structural component only
DWG# T-2007628

JOB NAME 408223	TRUSS NAME PB22	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 3.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:03:58 2020 Page 1

ID:DMCubINVR6TstFoe31v8l_zns11-2Mqjq7acil52eFKSNz9fEkmo2zyGJsPzqqDmTNzMEMI

Scale = 1:15.2

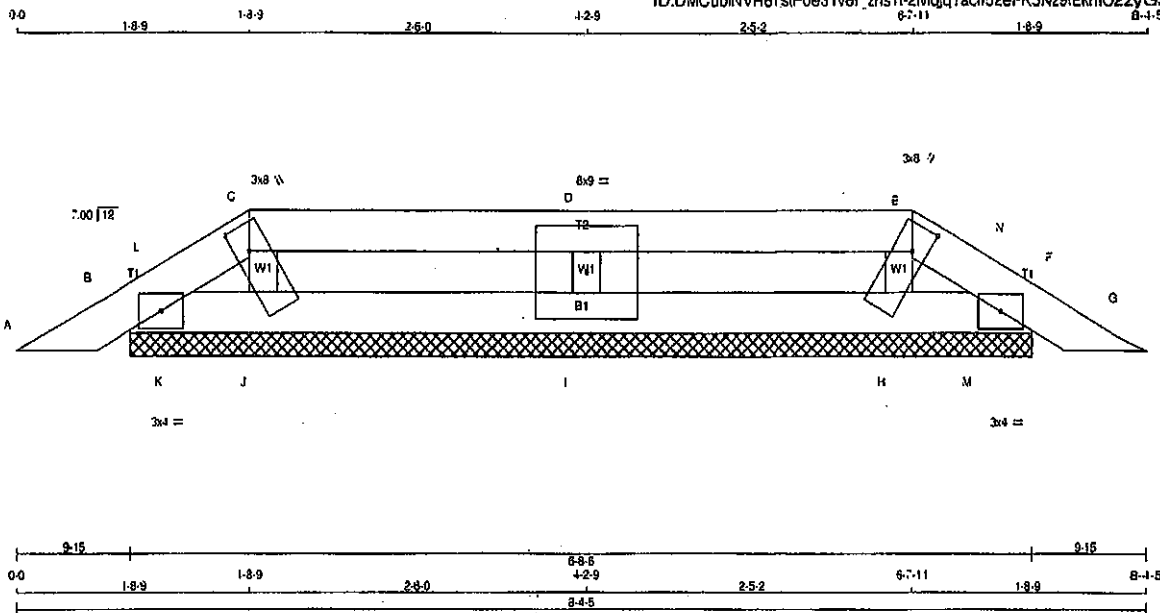

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
B - F	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMB1-I	MT20	3.0	4.0	
C, D, E, H, I, J					
C	TTBW1-h	MT20	3.0	8.0	2.25 1.25
D	TMBMW1-I	MT20	8.0	8.0	
E	TTBW1-h	MT20	3.0	8.0	2.25 1.25
F	TMB1-I	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	REQD
B	151	0	151	0	0	8-8-6	8-8-6
F	152	0	152	0	0	8-8-6	8-8-6
J	125	0	125	0	0	8-8-6	8-8-6
H	120	0	120	0	0	8-8-6	8-8-6
I	330	0	330	0	0	8-8-6	8-8-6

UNFACTORED REACTIONS

JT	1ST LOSE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
B	105	83 0 0 0 0 21 0 0 0
F	105	83 0 0 0 0 22 0 0 0
J	90	49 0 0 0 0 41 0 0 0
H	86	47 0 0 0 0 39 0 0 0
I	232	158 0 0 0 0 74 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, F, J, H, I.

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO		FROM TO		FR-TO		FROM TO	
A-B	0 16	-91.8 -91.8 0.04 (1)	10.00	J-C	-95 0	0.01 (1)	0.01 (1)
B-L	-53 0	-91.8 -91.8 0.04 (1)	6.25	H-E	-92 0	0.01 (1)	0.01 (1)
L-C	-22 0	-91.8 -91.8 0.01 (1)	6.25	I-D	-282 0	0.04 (1)	0.04 (1)
C-D	0 3	-91.8 -91.8 0.09 (1)	10.00	K-L	-1 12	0.00 (1)	0.00 (1)
D-E	0 3	-91.8 -91.8 0.09 (1)	10.00	M-N	0 13	0.00 (1)	0.00 (1)
E-N	-21 0	-91.8 -91.8 0.01 (1)	6.25				
N-F	-52 0	-91.8 -91.8 0.04 (1)	6.25				
F-G	0 16	-91.8 -91.8 0.04 (1)	10.00				
B-K	0 14	-18.5 -18.5 0.01 (1)	10.00				
K-J	0 14	-18.5 -18.5 0.02 (4)	10.00				
J-I	-3 0	-18.5 -18.5 0.02 (4)	10.00				
I-H	-3 0	-18.5 -18.5 0.02 (4)	10.00				
H-M	0 14	-18.5 -18.5 0.01 (4)	10.00				
M-F	0 14	-18.5 -18.5 0.01 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.09/1.00 (DE:1), BC=0.02/1.00 (J:4), WB=0.04/1.00 (D:1), SS=0.11/1.00 (C:D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MAX	MIN	MAX	MIN
MT20	618	354	1687 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.13 (C) INPUT = 0.90
JSI METAL = 0.04 (C) INPUT = 1.00




Structural component only
DWG# T-2007629

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	P20	17	1	TRUSS DESC.		

Yamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Tue Apr 28 10:03:55 2020 Page 1
ID:DMCubINVR8TstF0e31v6I zns11-en8bC XkMNIUnocWiqbyd68sgmus6UhwB17612zMEMo

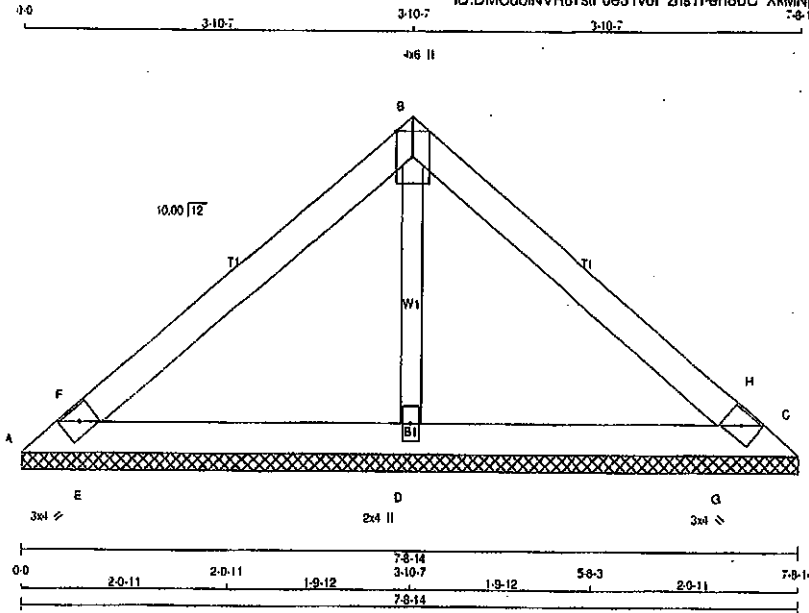

Scale = 1:20.4

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF	
B - C	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE	PLATES			
A - TBMI-h	MT20	3.0	4.0	
B - TTW+p	MT20	4.0	6.0	Edge
C - TBMI-h	MT20	3.0	4.0	
D - BMW1+vw	MT20	2.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
A	60	0	60	0
C	60	0	60	0
D	733	0	733	0

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LVE			
A	43	28.0	0.0	0.0	0.0	14.0
C	42	28.0	0.0	0.0	0.0	14.0
D	518	339.0	0.0	0.0	0.0	179.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO		FR-TO			
A-F	0 227	-91.8 -91.8 0.09 (1)	10.00	D-B	-558 0	0.10 (1)	
F-B	0 219	-91.8 -91.8 0.17 (1)	10.00	E-F	-199 0	0.00 (1)	
B-H	0 219	-91.8 -91.8 0.17 (1)	10.00	G-H	-199 0	0.00 (1)	
H-C	0 228	-91.8 -91.8 0.09 (1)	10.00				
A-E	-207 0	-18.5 -18.5 0.13 (1)	6.25				
E-D	-174 0	-18.5 -18.5 0.13 (1)	6.25				
D-G	-174 0	-18.5 -18.5 0.13 (1)	6.25				
G-C	-207 0	-18.5 -18.5 0.13 (1)	6.25				

TOTAL WEIGHT = 17 X 21 = 363 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS1: TC=0.17 1.00 (B-F:1) .8C=0.13/1.00 (D-E:1) .WB=0.10/1.00 (B-D:1) .SS1=0.11/1.00 (C-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1667	788	1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.29 (D) (INPUT = 0.90)
JSI METAL = 0.12 (D) (INPUT = 1.00)

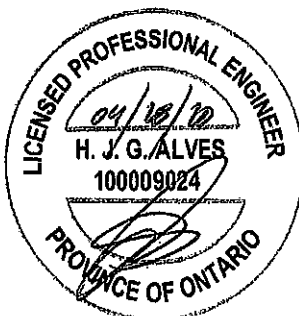

Structural component only
DWG# T-2007626

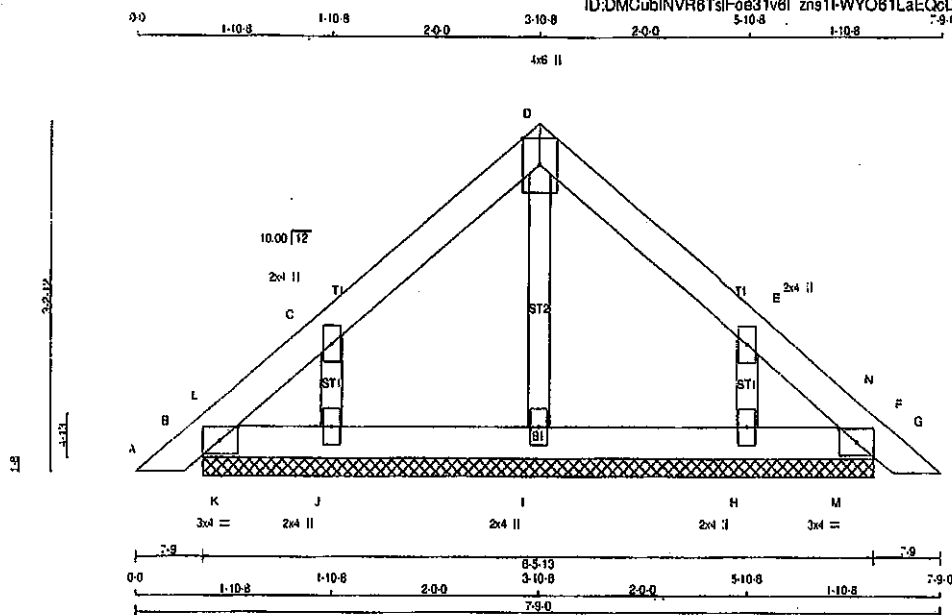


TOTAL WEIGHT = 2 X 22 = 45 lb

Structural component only
DWG# T-2007630

ID:DMCubINVR6TstFoe31v8| zns1l-uBTBW78oHNgUppVl5dnpEbl ZQFMuoV7BWCFEHHzMEI

Scale 1-220

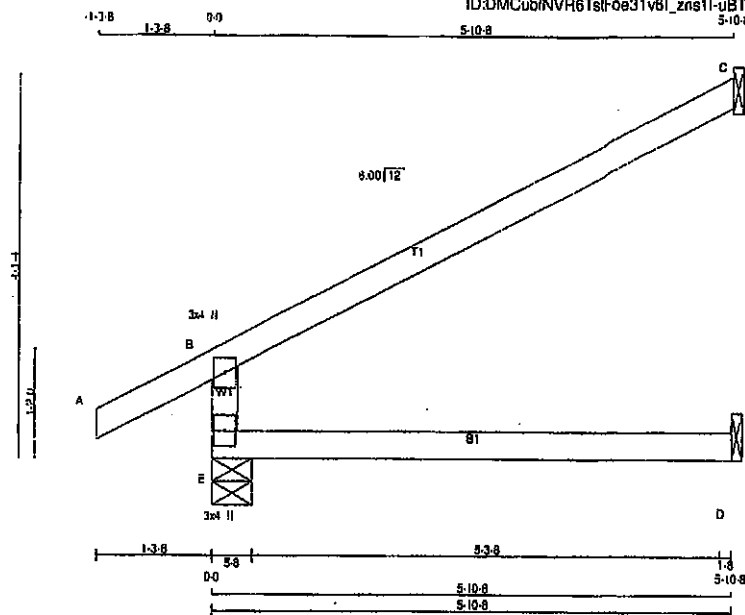

JSI GRIP = 0.19 (E), INPUT = 0.90
JSI METAL = 0.13 (B), INPUT = 1.00




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	J2S	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 MTek Industries, Inc. Tue Apr 26 09:00:01 2020 Page 1

ID:DMCubINVR6TstFoe31v8f_zns1l-uBTBW7BoHNgUpbVf5dpsEblhFOVoUrBWCfEIHZMFI

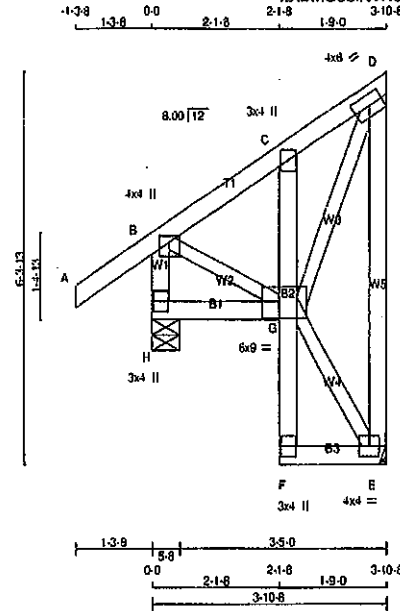

Scale = 1/32

TOTAL WEIGHT = 4 X 31 = 125 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
H - B	2x4	DRY	No.2	SPF	
A - D	2x4	DRY	No.2	SPF	
H - G	2x4	DRY	No.2	SPF	
F - C	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
E - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
C	TMV+p	MT20	3.0	4.0		
D	TMVW-i	MT20	4.0	6.0	2.00	2.75
E	BMVW-i	MT20	4.0	4.0		
F	BMV+p	MT20	3.0	4.0		
G	BMVW-i	MT20	6.0	9.0	3.25	3.50
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UPLIFT
H	332	0	332	0
E	208	0	208	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	232	168 0	0 0	0 0	0 0	66 0	0 0
E	145	95 0	0 0	0 0	0 0	50 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD	MEMB.	FORCE
(LBS)	(LBS)	(LBS)	(LBS)	(LBS)
FR-TO			FR-TO	
H-B	-311	0	H-B	0
A-B	0	35	A-B	0
B-C	-98	0	B-C	0
C-D	-105	0	C-D	0
H-G	0	0	H-G	0
F-G	0	15	F-G	0
G-C	-202	0	G-C	0
F-E	0	4	F-E	0

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TRIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.14+1.00 (A-B:5), BC=0.03+1.00 (G-H:4), WB=0.08+1.00 (D-E:1), SE=0.08+1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1687

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.22 (B), INPUT = 0.90 ; JSI METAL= 0.07 (C), INPUT = 1.00 ;



Structural component only
DWG# T-2007599

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	J20S	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:03:51 2020 Page 1
ID:DMCubINVR6TstFoe31v6t_zns1I-10v4McUDJ8C2IAIT_X?SGZA59ZPAq_xd41uHzMEMS

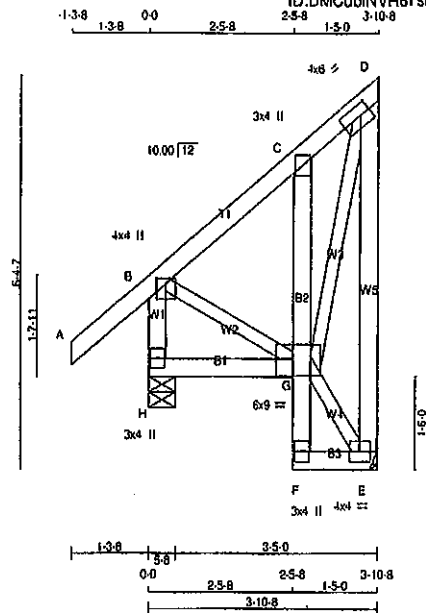

Scale = 1/4" = 1'-0"

TOTAL WEIGHT = 2 X 33 = 66 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
H - B	2x4	DRY	No.2	
A - D	2x4	DRY	No.2	
H - G	2x4	DRY	No.2	
F - C	2x4	DRY	No.2	
F - E	2x4	DRY	No.2	

ALL WEBS	2x3	DRY	No.2
EXCEPT			
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMW+p	MT20	4.0	4.0	1.00 2.00
C	TMW+p	MT20	3.0	4.0	
D	TMW+1	MT20	4.0	8.0	2.00 2.00
E	BMW+1	MT20	4.0	4.0	
F	BMW+p	MT20	3.0	4.0	
G	BMW+1	MT20	8.0	9.0	3.25 3.50
H	BMV+1	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
H	333	0	0	5-8
E	206	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	233	160	0	0	0	0	67	0
E	145	95	0	0	0	0	50	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	UNBRAC LENGTH	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
H-B	-309	0	0.0	0.0	0.03 (1)	7.81	B-G	0	70
A-B	0	41	-91.8	-91.8	0.14 (5)	10.00	E-D	-185	0
B-C	-70	0	-91.8	-91.8	0.07 (1)	8.25	G-E	-13	0
C-D	-92	0	-91.8	-91.8	0.06 (1)	6.25	G-D	0	215
H-G	0	0	-18.5	-18.5	0.04 (4)	10.00			
F-G	0	12	0.0	0.0	0.02 (1)	10.00			
G-C	-216	0	0.0	0.0	0.02 (1)	7.81			
F-E	0	8	-18.5	-18.5	0.01 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CS1: TC=0.14 (A-B), BC=0.04 (G-H), WB=0.08 (1.00 D-E), SS1=0.09 (1.00 A-B)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JS1 GRIP = 0.24 (B) (INPUT = 0.30)
JS1 METAL = 0.08 (C) (INPUT = 1.00)

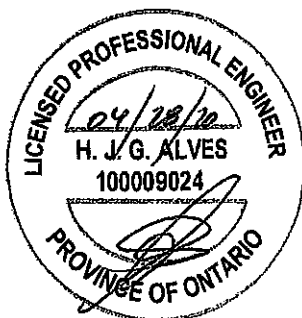

Structural component only
DWG# T-2007623


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	J22	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Tamarack Roof Truss, Burlington

Version 3.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:03:54 2020 Page 1

ID:DMCubINVR6TstFoe31v6I zns1l-AbaD eX6b3bd9e1K874j4ubgIMZPN21Nv2FYKczMEMp

Scale = 1/2" = 1'-0"

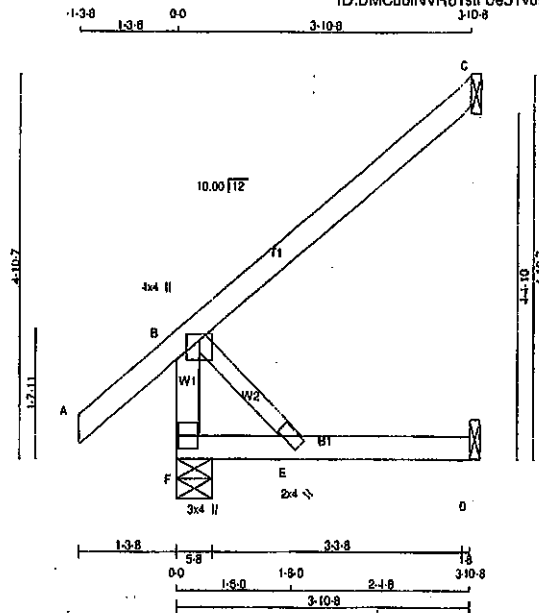

TOTAL WEIGHT = 3 X 15 = 45 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	SPF
F - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table in inches)				
JT	TYPE	PLATES	W.	LEN Y X
B	TMVW+p	MT20	4.0	4.0 1.00 2.00
E	BMVW+w	MT20	2.0	4.0
F	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER.

BEARINGS							
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	REGR
F	341	0	341	0	0	5-8	5-8
C	178	0	178	0	0	1-8	1-8
D	36	0	40	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B87791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
JT	1ST LC CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	COMBINED	170	0	0	0	89	0
C	COMBINED	99	0	0	0	23	0
D	COMBINED	0	0	0	0	29	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	UNBRACED LENGTH FR-TO
F-B	-305	0	0.0	0.0	0.03 (1)	7.81	8-E
A-B	0	41	-91.8	-91.8	0.14 (5)	10.00	
B-C	0	0	-91.8	-91.8	0.23 (1)	10.00	
F-E	0	0	-18.5	-18.5	0.08 (4)	10.00	
E-D	0	0	-18.5	-18.5	0.08 (4)	10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:		
TOP CH.	LL	= 25.6 PSF
	DL	= 8.0 PSF
BOT CH.	LL	= 0.0 PSF
	DL	= 7.4 PSF
TOTAL LOAD = 39.0 PSF		

SPACING = 24.0 IN. CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.18")
CALCULATED VERT. DEFL. (TL) = L/999 (0.01")

CSI: TC=0.23/1.00 (B-C:1), BC=0.08/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (B) (INPUT = 0.90)
JSI METAL = 0.08 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007625

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	J40	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:52 2020 Page 1
ID:DMCubINVR6TstF0e31v6i zns1l-6uTN2C71 PHh5sGSGJGMvwHM XXOqKBNC5JFy4zME7r

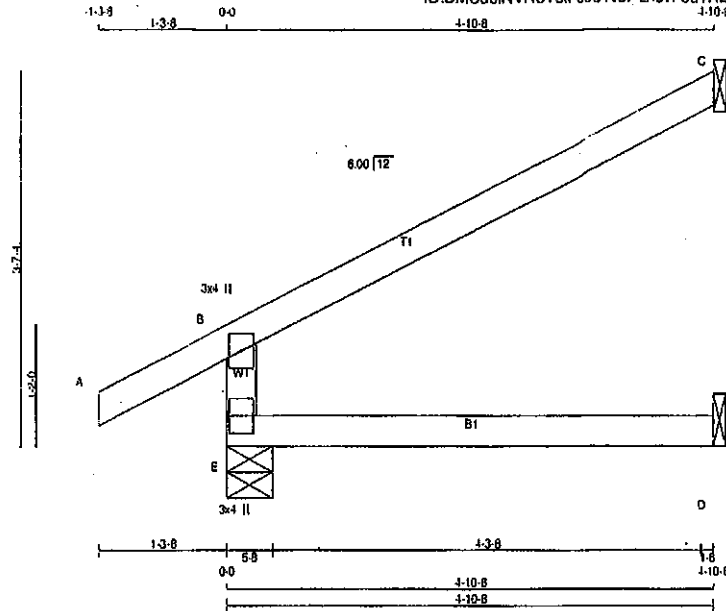

Scale = 1/20.0

TOTAL WEIGHT = 2 X 14 = 28 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		RECORD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
E	458	0	458	0	0	5-8	5-8	
C	168	0	168	0	0	1-8	1-8	
D	38	0	42	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL 697791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
E	320	225	0	0	0	95	0
C	116	94	0	0	0	22	0
D	30	0	0	0	0	30	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. (PLP)	MAX. (LC)	MAX. UNBRAC	MEMB.	MAX. FORCE (LBS)	MAX. (LC)
FR-TO		FROM	TO		LENGTH	FR-TO		
E-B	-104 0	0.0	0.0	0.08 (4)	7.81			
A-B	0 25	-91.8	-91.8	0.12 (1)	10.00			
B-C	-25 0	-91.8	-91.8	0.37 (1)	6.25			
E-D	0 0	-18.5	-18.5	0.09 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

ISS % OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.37 (B-C:1), BC=0.09 (D-E:4), WB=0.00 (A-B:0), SSI=0.20 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1587 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (E) (INPUT = 0.90)
JSI METAL= 0.11 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007657

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	J41	5	1	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:54 2020 Page 1
ID:DMCubINVR8TslFos31v8l znsf1-3Hb7Tu8HW1XPKAQqNkQJ.LMmLEmtEhglPoM1zzME7p

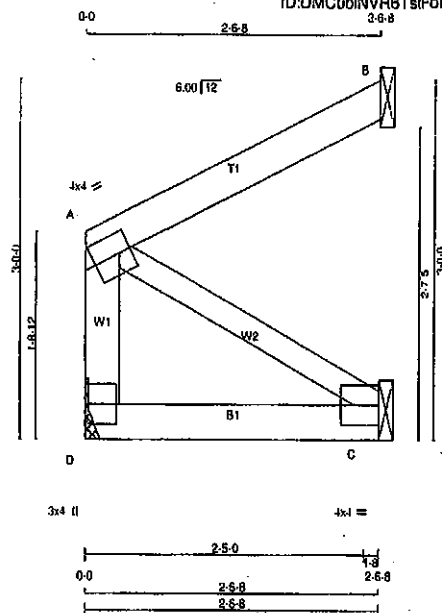

Scale = 1:17.8

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
D - A	2x4	DRY	No.2	
A - B	2x4	DRY	No.2	
D - C	2x4	DRY	No.2	
ALL WEBS	2x3	DRY	No.2	
DRY: SEASONED LUMBER.				

PLATES (tablets in inches)	JT TYPE	PLATES	W	LEN	Y	X
A - TMVW+	MT20	4.0	4.0	2.00	1.25	
C - BMV1+	MT20	4.0	4.0	2.00	Edge	
D - BMV1+	MT20	3.0	4.0			

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT REQD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX
D	139	0	139	0	0	MECHANICAL
B	117	0	117	0	1-8	1-8
C	23	0	25	0	1-8	1-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B..C

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX. MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	98	65 0	0 0	0 0	0 0	33 0	0 0
B	80	65 0	0 0	0 0	0 0	15 0	0 0
C	18	0 0	0 0	0 0	0 0	18 0	0 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHOROS					WEBS				
MEMB.	MAX. FACTORED		FACTORED		MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED		MAX. CS1 (LC)
	FORCE (LBS)		VERT. LOAD (PLF)	LC1 (LC)			FORCE (LBS)		
FR-TO			FROM	TO		FR-TO			
D-A	-117	0	0.0	0.0	0.01 (1)	A-C	0	0	0.00 (1)
A-B	0	0	-91.8	-91.8	0.10 (1)				
D-C	0	0	-18.5	-18.5	0.03 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TU) = L/999 (0.00")

CSI: TC=0.10/1.00 (A-B:1) . BC=0.03/1.00 (C-D:4) .
WB=0.00/1.00 (A-C:1) . SS=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.07 (A) (INPUT = 0.90)
JSI METAL = 0.02 (A) (INPUT = 1.00)




Structural component only
DWG# T-2007658

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	J42	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:55 2020 Page 1

ID:DMCubINVR6TstFoa31v6I zns1l-XT8WgE9vHKIGyK?1xSq3XYumIX 1hxqu3YvZPzME7c

Scale = 1:22.9

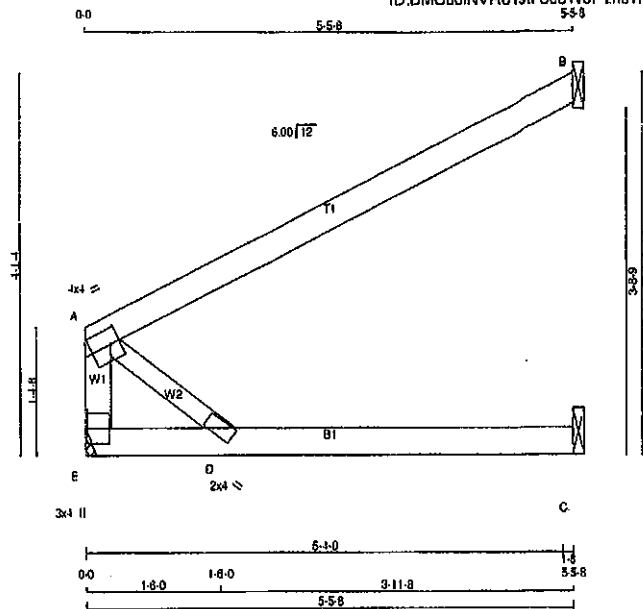

TOTAL WEIGHT = 2 X 16 = 31 LB

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - A	2x4	DRY	No.2
A - B	2x4	DRY	No.2
E - C	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY; SEASONED LUMBER.			

DESCR.
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORZ	BRG	BRG	IN-SX	IN-SX
E	301	0	301	0	0	MECHANICAL			
B	250	0	250	0	0	1-8	1-8		
C	50	0	57	0	0	1-8	1-8		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	213	140'0	0'0	0'0	0'0	73'0	0'0
B	172	140'0	0'0	0'0	0'0	33'0	0'0
C	40	0'0	0'0	0'0	0'0	40'0	0'0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: 14)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
E-A	-250 0	0.0 0.0	0.03 (1)	A-D	0 0	0.00 (1)	
A-B	0 0	-91.8 -91.8	0.46 (1)				
E-D	0 0	-18.5 -18.5	0.13 (4)				
D-C	0 0	-18.5 -18.5	0.16 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19')
CALCULATED VERT. DEFL.(LL) = L/999 (0.00')
ALLOWABLE DEFL.(TL) = L/360 (0.19')
CALCULATED VERT. DEFL.(TL) = L/999 (0.04')

CSI: TC=0.46/1.00 (A-B:1), BC=0.16/1.00 (C-D:4), WB=0.00/1.00 (A-D:1), SS=0.17/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.15 (A) (INPUT = 0.90)
JSI METAL = 0.04 (A) (INPUT = 1.00)




Structural component only
DWG# T-2007659

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C40	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 3.310 S Oct 29 2019 MTak Industries, Inc. Tue Apr 28 10:19:42 2020 Page 1

ID:DMCubINVR6TstFoe31v6l zns11-Pzsbyo?ILL16uKVXgD50VpshpV5QUoJwXujdizME8?

Scale = 1:17.8

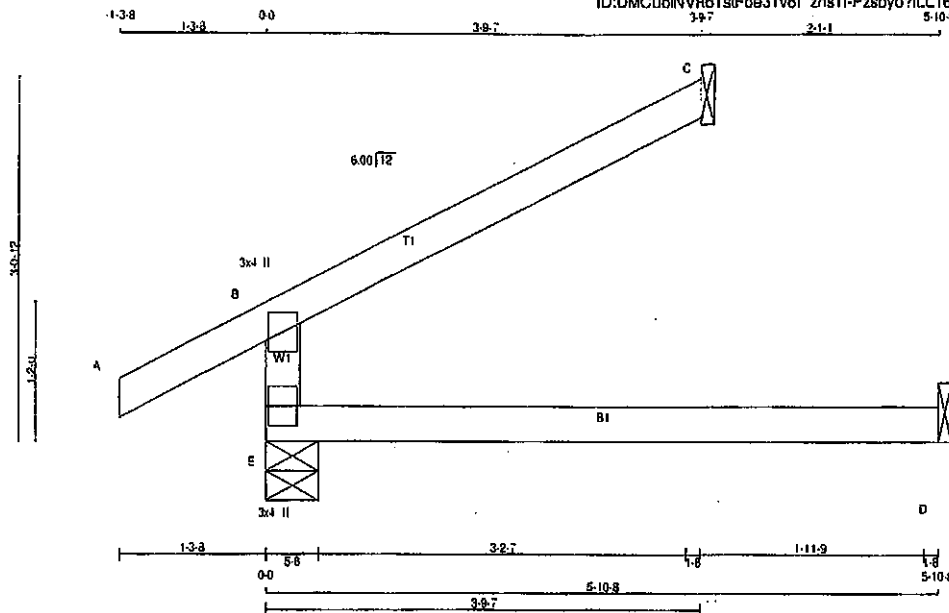

TOTAL WEIGHT = 2 X 14 = 28 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No. 2	SPF		
A - C	2x4	DRY	No. 2	SPF		
E - D	2x4	DRY	No. 2	SPF		

DRY: SEASONED LUMBER.

PLATES (tablets in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0			
E	BMV1+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORZ	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
E	405	0	405	0	5-8	5-8
C	130	0	130	0	1-8	1-8
D	45	0	50	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	288	190	0	0	0	0	96	0
C	90	73	0	0	0	0	17	0
D	38	0	0	0	0	0	36	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. UNBRACED LENGTH FR-TO	MEMB. FORCE (LBS)
FR-TO		FROM TO		
E-B	-342	0	0.0	0.0
A-B	0	28	-91.8	-91.8
B-C	-19	0	-91.8	-91.8
E-D	0	0	-18.5	-18.5

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 8.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.22/1.00 (B-C:1), BC=0.13/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354
	1687	788
	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (E) INPUT = 0.90)
JSI METAL= 0.09 (D) INPUT = 1.00)




Structural component only
DWG# T-2007648

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C41	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:44 2020 Page 1
ID:DMCubINVR6TsiFoe3Iv8I zns1I-LM MNT0?IyHq7dfvce7UaEx3uJnoyDCMtrNagYzME7z
5-10-8

Scale = 1:13.1

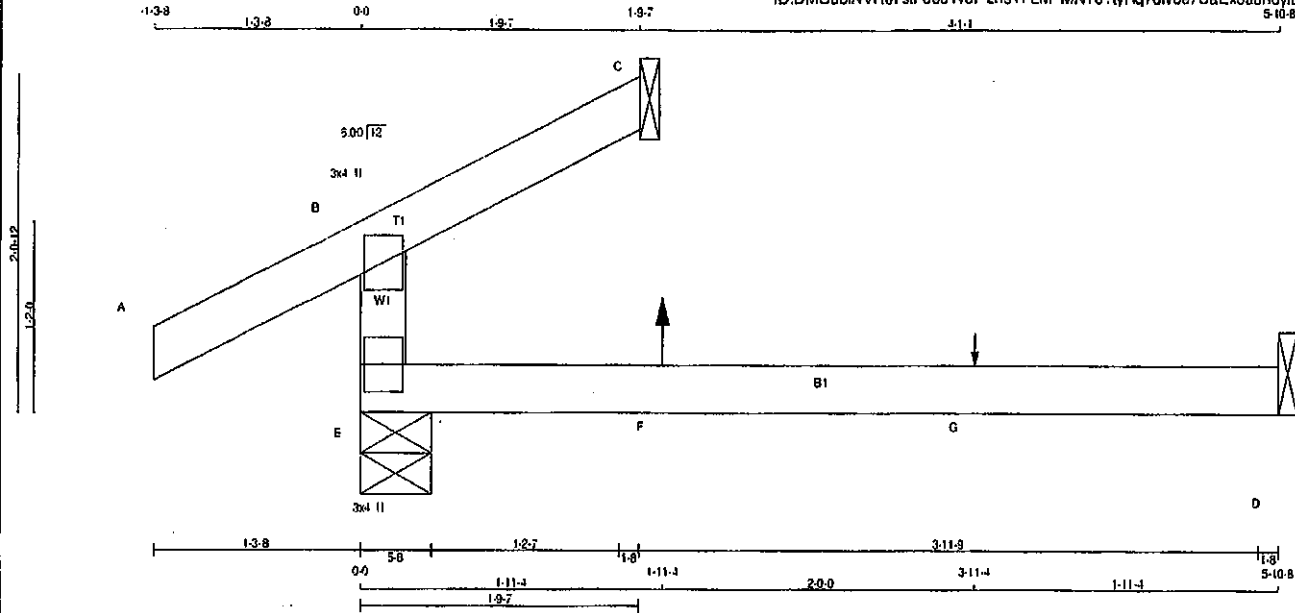

TOTAL WEIGHT = 2 X 12 = 23 lb
(M)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4 DRY	No. 2	SPF		
A - C	2x4 DRY	No. 2	SPF		
E - D	2x4 DRY	No. 2	SPF		

DRY: SEASONED LUMBER.

PLATES (tablets in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING DESIGNER							
<u>BEARINGS</u>							
	FACTORED		MAXIMUM FACTORED		INPUT	REQRD	
	GROSS REACTION		GROSS REACTION		BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	
E	284	0	284	0	0	5-8	
C	63	0	83	0	0	1-8	
D	44	0	52	0	0	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	IST LCASE	MAX. MIN. COMPONENT REACTIONS		PERM. LIVE	WIND	DEAD	SOIL
		SNOW	LIVE				
E	200	137	0	0	0	0	0
C	46	21	0	0	0	0	0
D	35	0	3	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (7)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO			FR-TO		
E-B	-227 0	0.0 0.0	0.11 (4)	7.81			
A-B	0 28	-91.8 -91.8	0.12 (1)	10.00			
B-C	-9 9	-91.8 -91.8	0.08 (4)	10.00			
E-F	0 0	-18.5 -18.5	0.14 (4)	10.00			
F-G	0 0	-18.5 -18.5	0.14 (4)	10.00			
G-D	0 0	-18.5 -18.5	0.14 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
F	1-11-4	7	1	12	BACK	VERT	TOTAL	---	C1
G	3-11-4	1	1	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

11 C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CS1: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4), WB=0.00/1.00 (A-B:0), SS1=0.09/1.00 (A-B:1)

DOL LUMBER=0.98 NAIL=0.98 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1997 1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (E) INPUT = 0.90
JSI METAL= 0.06 (B) INPUT = 1.00




Structural component only
DWG# T-2007649

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DWG NO.
408224	C42	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:45 2020 Page 1

ID:DMCubINVR6TstFos31v6I zns11-pYYkap1eeGPhnE6LLq7RUC2j9wh9SMbV7NC zME7y

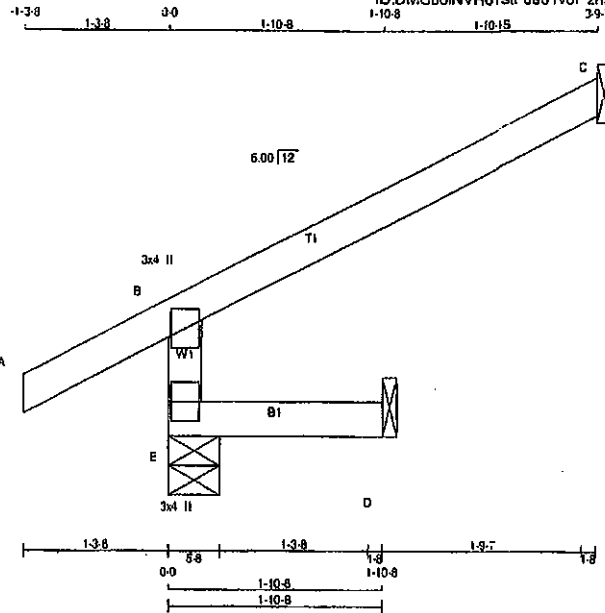

Scale = 1/16" = 1'-0"

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	381	0	381	0	0	5-8	5-8
C	130	0	130	0	0	1-8	1-8
D	18	0	17	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B87791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	250	190	0	0	0	0	80	0
C	90	73	0	0	0	0	17	0
D	12	0	0	0	0	0	12	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)	W E B S	MAX. FACTORED MEMB. FORCE (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)
FR-TO					FROM TO		
E - B	-342	0	0	0	0.01 (4)	7.81	
A - B	0	28	-91.8	-91.8	0.13 (5)	10.00	
B - C	-19	0	-91.8	-91.8	0.22 (1)	8.25	
E - D	0	0	-18.5	-18.5	0.02 (4)	10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:	TOP CH.	LL	PSF
	DL	25.6	PSF
SPECIFIED LOADS:	BOT CH.	LL	PSF
	DL	6.0	PSF
	DL	7.4	PSF
	TOTAL LOAD	39.0	PSF

SPACING = 24.0 IN. GC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.22/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (A-B:0), SI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (FSL) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.14 (E) (INPUT = 0.99)
JSI METAL = 0.09 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007650

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C43	3	1	GREEN PARK HOMES	
				TRUSS DESC.	

Truss: Roor Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:46 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-lk66o92GPpXYNxp1v39yff10Q6VqQciVq9sxtRzME7x

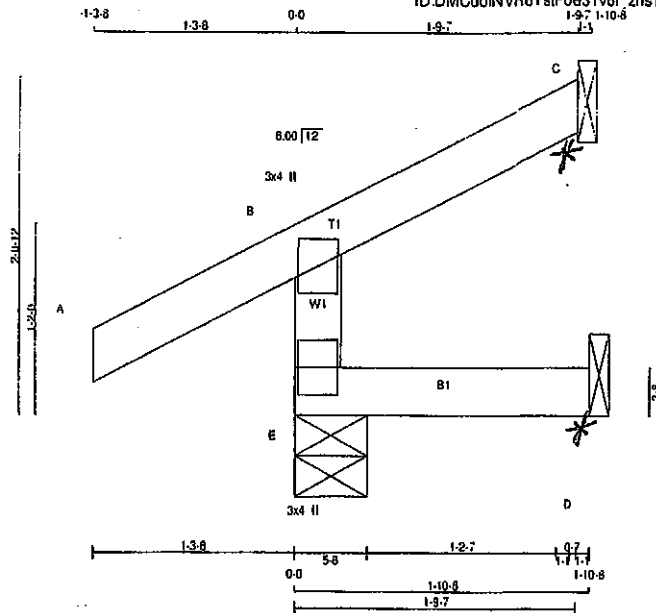

TOTAL WEIGHT = 3 X 7 = 21 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
E	BMV+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	GROSS REACTION	GROSS REACTION	GROSS REACTION	BRG	BRG
E	271	0	271	0	5-8
C	45	0	45	0	-23
D	8	0	17	0	-2

SEE MITEK STANDARD DETAIL B87791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS		1ST LOOSE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
E	188	141	0	0.0	0.0	47	0	0
C	31	24	-18	0	0	7	0	0
D	7	0	-8	0	0	12	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		MAX. FACTORED	FACTORED	VERT. LOAD LC1	MAX. FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. (PLF)	CS1 (LC)	UNBRAC	MEMB.	FORCE (LBS)	CS1 (LC)
FR-TO		FROM	TO	LENGTH	FR-TO		
E-B	244	0	0.0	0.0	0.04 (5)	7.81	
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00	
B-C	-17	0	-91.8	-91.8	0.09 (1)	6.25	
E-D	0	0	-18.5	-18.5	0.04 (5)	10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/899 (0.00")

CSI: TC=0.12/1.00 (A-B:1) . BC=0.04/1.00 (D-E:5) .
WB=0.00/1.00 (A-B:0) . SSI=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (5) INPUT = 0.90
JSI METAL = 0.07 (8) INPUT = 1.00



Structural component only
DWG# T-2007651

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C44	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 26 10:19:47 2020 Page 1	

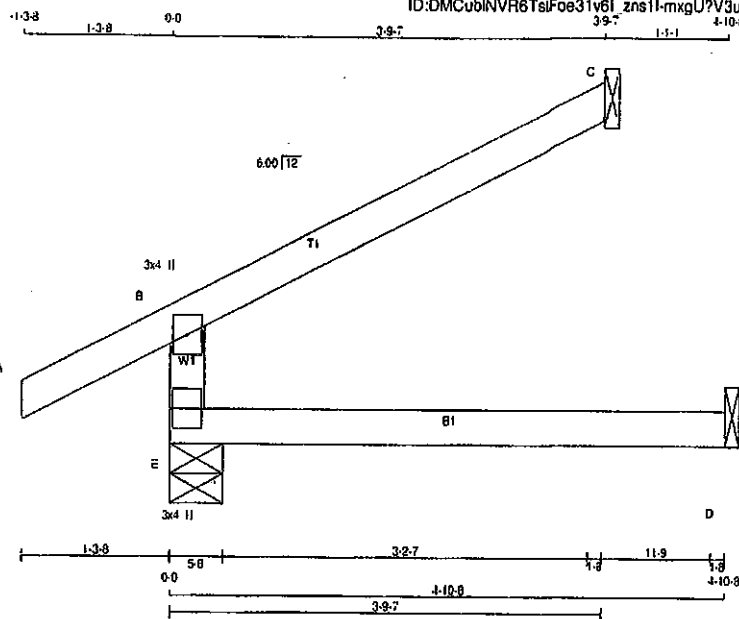

Scale = 1/16"

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (Table is in inches)				
JT TYPE	PLATES	W	LEN	Y
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

DESCR.	SPF	BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REORD	
		GROSS REACTION	VERT	GROSS REACTION	HORIZ	GROSS REACTION	DOWN	GROSS REACTION	UP	BRG	BRG
JT	SPF	394	0	394	0	394	0	394	0	5-8	5-8
E	SPF	130	0	130	0	130	0	130	0	1-8	1-8
C	SPF	38	0	42	0	42	0	42	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

JT	COMBINED	UNFACTORED REACTIONS					
		1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD
E	277	190	0	0	0	0	87
C	90	73	0	0	0	0	17
D	30	0	0	0	0	0	30

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		WEBS		FACTORED	
	MAX.	FORCE	VERT. LOAD	LC1 MAX	MAX.	MEMB.	MAX.	FORCE
FR-TO		(LBS)	(PLF)	CSI (LC)	UNBRAC			CSI (LC)
E-B	-342	0	0.0	0.0 (4)	7.81			
A-B	0	28	-91.8	-91.8 (1)	10.00			
B-C	-19	0	-91.8	-91.8 (1)	6.25			
E-D	0	0	-18.5	-18.5 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.22(1.00 (B-C:1), BC=0.09(1.00 (D-E:1), WB=0.00(1.00 (me:0), SSI=0.15(1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MT20	818	354
	1667	788
	1987	1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.14 (E) INPUT = 0.90
JSI METAL = 0.09 (B) INPUT = 1.00



Structural component only
DWG# T-2007652


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	C45	2	1	TRUSS DESC.		

Yamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 26 10:19:48 2020 Page 1

ID:DMCubINVR6TslFoe31v6l_zns1l-E7DsCr3WxBnFcFyq1UCQ46kwwAMuWC0HTL1pJzME7v

Scale = 1:13.1

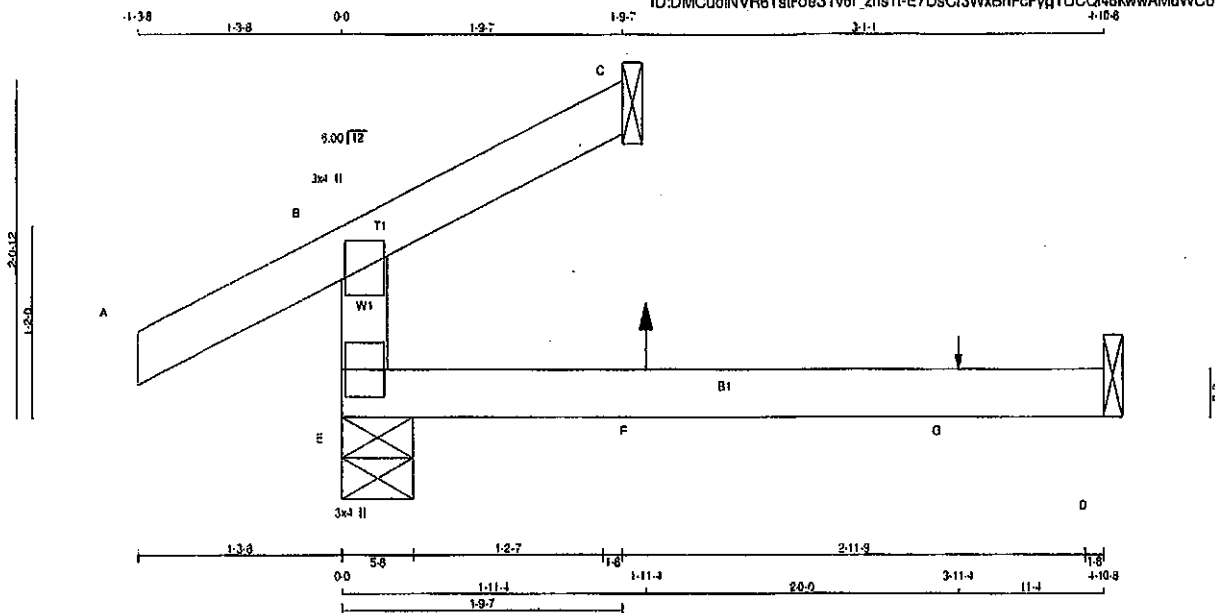

TOTAL WEIGHT = 2 X 10 = 21 lb

LUMBER	N. L. G. A. RULES	CHOROS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0			
E	BMV1+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG	IN-SX
E	282	0	282	0	0	0	5-8	5-8	
C	55	0	55	0	0	0	1-8	1-8	
D	35	0	44	0	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST LOASE		MAX. MIN. COMPONENT REACTIONS		WIND		DEAD		SOR.	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOR.	JT	COMBINED	SNOW	LIVE
E	198	137	0	0	0	0	0	81	0	0	0
C	39	21	0	0	0	0	0	18	0	0	0
D	29	0	4	0	0	0	0	31	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (7)

CHOROS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. MAX. (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. MAX. (LBS)	MAX. MAX. (LBS)
FR-TO		FROM	TO	LENGTH	FR-TO		
E-B	235	0	0.0	0.0	0.07 (4)	7.81	
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00	
B-C	-13	5	-91.8	-91.8	0.07 (0)	8.25	
E-F	0	0	-18.5	-18.5	0.10 (4)	10.00	
F-G	0	0	-18.5	-18.5	0.10 (4)	10.00	
G-D	0	0	-18.5	-18.5	0.10 (4)	10.00	

FACTORED CONCENTRATED LOADS (LBS)		FACE		DIR.		TYPE		HEEL		CONN.	
JT	LOC	LC1	MAX.	MAX.	BACK	VERT	TOTAL	---	---	---	---
F	1-11-4	7	1	12	BACK	VERT	TOTAL	---	---	---	---
G	3-11-4	1	1	---	BACK	VERT	TOTAL	---	---	---	---

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.12/1.00 (A-B:1), BC=0.10/1.00 (D-E:4), WB=0.00/1.00 (r=0.0), SS=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1650

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.10 (E) INPUT = 0.90
JSI METAL= 0.07 (B) INPUT = 1.00



Structural component only
DWG# T-2007653

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C46	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:19:46 2020 Page 1
ID:DMCubINVR6TslFoe31v6l zns1l-iJnEQB48hJv6EPXlaBjHhfuKKVjdZsXW75bLizME7u

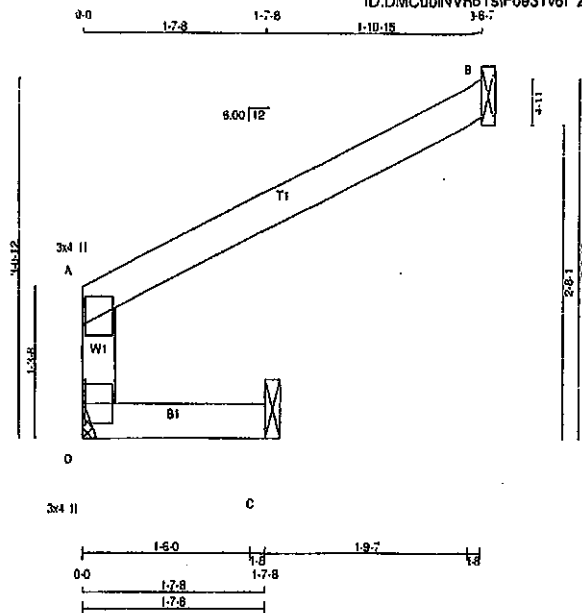

Scale = 1:10.2

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			SPF
D - A	2x4	DRY	No.2
A - B	2x4	DRY	No.2
D - C	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
A - TMV+p	MT20	3.0	4.0	
D - BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	DOWN	UP	BRG
D	156	0	156	0	MECHANICAL
B	144	0	144	0	1-8
C	55	0	55	0	1-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	COMBINED	78	0	0	0	0	31	0
B		80	0	0	0	0	19	0
C		23	0	0	0	0	17	0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: 14)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
D-A	-181	D-A	0.0
A-B	-8	A-B	-91.8
D-C	0	D-C	-18.5

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. O.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.197)
CALCULATED VERT. DEFL. (LL) = L/999 (0.007)
ALLOWABLE DEFL. (TL) = L/360 (0.197)
CALCULATED VERT. DEFL. (TL) = L/999 (0.007)

CSI: TC=0.14/1.00 (A-B:1), BC=0.09/1.00 (C-D:1), WB=0.00/1.00 (A-B:1), SSI=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1867 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.08 (D) INPUT = 0.90
JSI METAL = 0.05 (A) INPUT = 1.00




Structural component only
DWG# T-2007654

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C47	1	1	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:19:50 2020 Page 1

ID:DMCubINVR6T9IFoe31v8I zns1t-AWLddX5mSo1zrY638uEuqVB6sks7MQI5knq8uCzME7

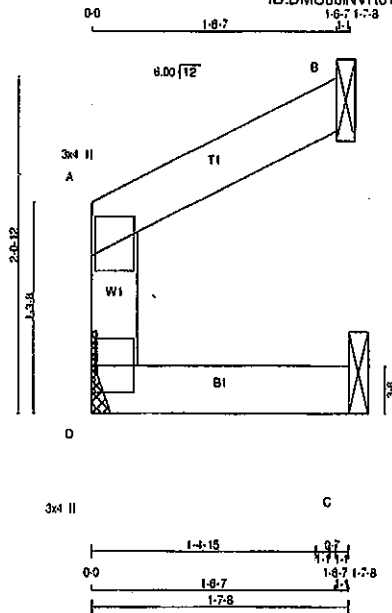

Scale = 1:12.1

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
D - A	2x4	ORY	No.2
A - B	2x4	ORY	No.2
D - C	2x4	ORY	No.2

DRY; SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMV+p	MT20	3.0	4.0	
D	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG.	BRG
JT	VERT	HORZ	DOWN	HORZ
D	88	0	88	0
B	87	0	67	0
C	19	0	19	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

SEE MTEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINTS B & C

UNFACTORED REACTIONS

JT	1ST LCASE	MAX.	MIN.	COMPONENT REACTIONS
	COMBINED	SNOW	LIVE	PERM.LIVE
D	81	39	0	0
B	46	37	0	0
C	14	2	0	0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	VERT. LOAD	FACTORED	MEMB.	MAX. FACTORED	VERT. LOAD	FACTORED
	FORCE	(PL)	LC1		FORCE	(PL)	LC1
FR-TO				FR-TO			
D-A	-74	0	0.0	0.0	0.0	0.0	7.81
A-B	-2	0	-91.8	-91.8	0.0	0.0	10.00
D-C	0	0	-18.5	-18.5	0.0	0.0	10.00

DESIGN CRITERIA

SPECIFIED LOADS:		
TOP CH.	LL	= 25.6 PSF
	DL	= 6.0 PSF
BOT CH.	LL	= 0.0 PSF
	DL	= 7.4 PSF
TOTAL LOAD		= 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

15% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.03/1.00 (A-B:1), BC=0.01/1.00 (C-D:4),
WB=0.00/1.00 (A-B:1), SS=0.05/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)
MAX	MIN	MAX
MT20	618	354
	1667	788
	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.03 (D) (INPUT = 0.90)
JSI METAL = 0.02 (A) (INPUT = 1.00)



Structural component only
DWG# T-2007655

LUL/LUS/LJS/HUS/HHUS/HGUS

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.

Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1 1/4" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options Information on p. 126.




Double-Shear
Nailing
Top View




Double-Shear
Nailing
Side View;
Do not
bend tab




Dome Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,560

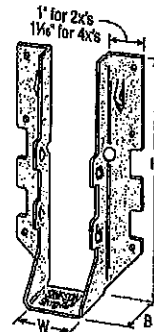


✓ LUS28




LU26L

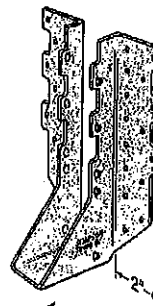


✓ HUS210
(HUS26, HUS28,
and HHUS similar)



✓ HGUS28-2




✓ HHUS210-2



LJS26DS

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

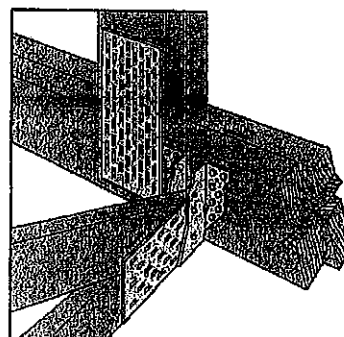

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options Information on pp. 125–127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
W < 2"	Bevel or square cut	0.62 of table value	0.46 of table value
2" < W < 6"	Bevel cut	0.67 of table value	0.41 of table value
2" < W < 6"	Square cut	0.46 of table value	0.41 of table value
W > 6"	Bevel cut	0.75 of table value	0.41 of table value

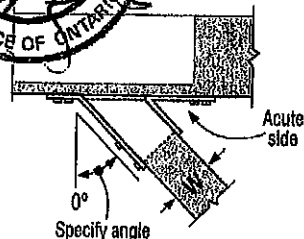

Top View HHUS Hanger Skewed Right
(joist must be bevel cut)
All joist nails installed on the outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _g ³	Header	Joist	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)
								lb.	lb.	lb.	lb.
kN											
Single 2x Sizes											
LUS24	18	1 9/16	3 1/4	1 3/4	2 1/4	(4) 10d	(2) 10d	710 3.16	1625 7.23	845 2.87	1155 5.14
LU24L	22	1 9/16	3	1 3/4	2 1/8	(4) 10d	(2) 10d x 1 1/2"	360 1.60	1020 4.54	320 1.42	725 3.22
LU26L	22	1 9/16	5	1 3/4	4 3/4	(6) 10d	(4) 10d x 1 1/2"	720 3.20	1605 7.14	645 2.87	1140 5.07
LUS26	18	1 9/16	4 3/4	1 3/4	3 3/4	(4) 10d	(4) 10d	1420 6.32	2170 9.65	1290 5.74	1830 7.25
HUS26	16	1 5/8	5 3/4	3	3 1/8	(14) 10d	(8) 10d	2705 11.30	4940 21.97	2065 9.20	3875 17.24
LJS26DS	18	1 9/16	5	3 1/2	4 3/4	(16) 10d	(6) 10d	2055 9.14	4265 18.97	1460 6.49	4115 18.31
HGUS26	12	1 5/8	5 3/4	5	4 3/4	(20) 10d	(8) 10d	2885 -11.96	6625 29.51	2685 11.96	5700 25.35
LU28L	20	1 9/16	6 3/4	1 3/4	5 3/4	(8) 10d	(6) 10d x 1 1/2"	1140 5.07	2185 9.72	1020 4.54	1550 6.89
LUS28	18	1 9/16	6 3/4	1 3/4	3 3/4	(6) 10d	(4) 10d	1420 6.32	2520 11.21	1290 5.74	1790 7.96
HUS28	16	1 5/8	7 3/4	3	6 1/8	(22) 10d	(8) 10d	3605 16.04	5365 23.88	2675 11.90	4345 19.33
HGUS28	12	1 5/8	7 3/4	5	6 3/4	(36) 10d	(12) 10d	3310 14.74	7675 34.19	3310 14.74	6900 30.73
LU210L	20	1 9/16	8	1 3/4	7 3/4	(10) 10d	(8) 10d x 1 1/2"	1140 5.07	2495 11.10	1020 4.54	1770 7.87
LUS210	18	1 9/16	7 3/4	1 3/4	3 3/4	(8) 10d	(4) 10d	1420 6.32	2785 12.39	1290 5.74	2210 9.83

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.

2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.

3. d_g is the distance from the bearing seat to the top joist nail.

4. Resistances shown require a minimum 2-ply glider truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSON and/or see installation notes.

5. Nails: 16d = 0.182" dia. x 3 1/4" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers


SIMPSON

Strong-Tie®

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _o ²	Header	Joist	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _p = 1.15)	(K _p = 1.00)	(K _p = 1.15)	(K _p = 1.00)
								lb.	lb.	lb.	lb.
								kN	kN	kN	kN
Double 2x Sizes											
SS LUS24-2	18	3 1/8	3 1/8	2	1 1/2	(4) 18d	(2) 16d	835	2020	590	1435
								3.71	8.99	2.62	6.38
SS LUS26-2	18	3 1/8	4 1/8	2	4	(4) 18d	(4) 16d	1720	2595	1545	1920
								7.65	11.54	6.87	8.54
HHUS26-2	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	2850	7335	2085	5205
								12.68	32.83	9.20	23.15
HGUS26-2	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
SS LUS28-2	18	3 1/8	7	2	4	(6) 18d	(4) 16d	1720	3325	1545	2675
								7.65	14.79	6.87	11.45
HHUS28-2	14	3 1/8	7 1/8	3	8 1/8	(22) 16d	(8) 16d	3765	8940	2675	6345
								16.75	39.77	11.90	28.22
HGUS28-2	12	3 1/8	7 1/8	4	8 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
SS LUS210-2	18	3 1/8	9	2	6	(8) 18d	(6) 16d	2580	4500	2320	3195
								11.48	20.02	10.32	14.21
HHUS210-2	14	3 1/8	9 1/8	3	8	(30) 16d	(10) 16d	4670	9660	4235	7000
								20.77	42.97	18.84	31.14
HGUS210-2	12	3 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	6840	14015	4855	10270
								30.43	62.34	21.60	45.69
Triple 2x Sizes											
HGUS26-3	12	4 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-3	12	4 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d	4670	9670	4235	6865
								20.77	43.02	18.84	30.54
HGUS210-3	12	4 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.26
Quadruple 2x Sizes											
HGUS26-4	12	6 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-4	12	6 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-4	14	6 1/8	8 1/8	3	7 1/8	(30) 16d	(10) 16d	4670	10155	4235	7210
								20.77	45.17	18.84	32.07
HGUS210-4	12	6 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.26
HGUS212-4	12	6 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	7640	14995	5425	10845
								33.98	66.70	24.13	47.35
HGUS214-4	12	6 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	51.80
4x Sizes											
LUS46	18	3 1/8	4 1/8	2	3 1/8	(4) 18d	(4) 16d	1720	2595	1545	1920
								7.65	11.54	6.87	8.54
HHUS46	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	2540	7335	2085	5205
								11.30	32.63	9.20	23.15
HGUS46	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
LUS48	18	3 1/8	6 1/8	2	3 1/8	(6) 18d	(4) 16d	1720	3325	1545	2675
								7.65	14.79	6.87	11.45
HHUS48	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3765	8940	2675	6345
								16.75	39.77	11.90	28.22
HGUS48	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
LUS410	18	3 1/8	8 1/8	2	5 1/8	(8) 18d	(6) 16d	2580	4500	2320	3195
								11.48	20.02	10.32	14.21
HGUS410	12	3 1/8	9	4	8 1/8	(46) 16d	(16) 16d	6840	14015	4855	10270
								30.43	62.34	21.60	45.69
HGUS412	12	3 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	7640	14995	5425	10845
								33.98	66.70	24.13	47.35
HGUS414	12	3 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	51.80



Plated Truss Connectors

See footnotes
on p. 258.

TC – Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1¼". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1½" = 0.148" dia. x 1½" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

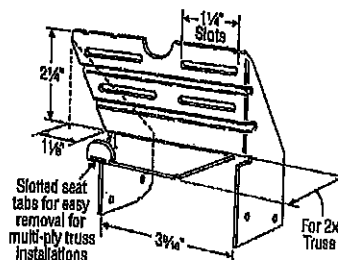


TC24
U.S. Patent 4,932,173

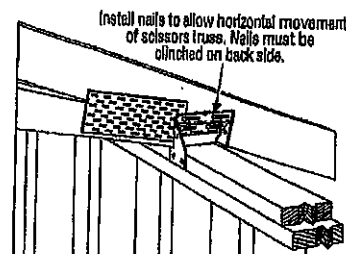


Typical TC24 Installation

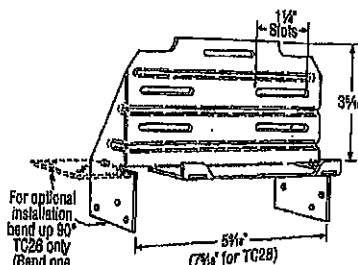

TC26
(TC28 Similar)

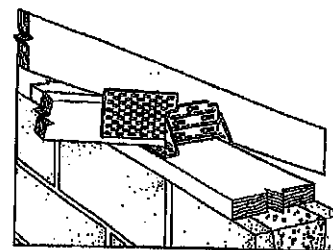

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer
(8", 10", 12" Wall Installation Similar)

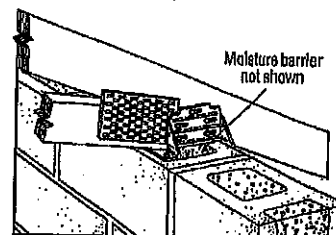

Optional TC26 Installation for Grouted Concrete Block using Titen® Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D-Fir-L	S-P-F
			Uplift ($K_p=1.15$)	Uplift ($K_p=1.15$)
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(5) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D-Fir-L	S-P-F
			Uplift ($K_p=1.15$)	Uplift ($K_p=1.15$)
TC26	(5) 10d	(6) 10d x 1½"	810	660
	(5) 10d	(6) 10d	930	660

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.

2. Grout strength is 15 MPa minimum.

3. Optional TC26 installation with 10d nails requires minimum 3" top plate thickness.

4. TC26 fastened to grouted concrete block with (8) - 9/16" x 2¼" Titen® screws has a factored uplift resistance of 276 lb.



STATE
DESIGN

2017 Simpson Strong-Tie Company

SP-601-15-17, 1/17, and 1/18

(800) 999-5099
strongtie.com

H/TSP**SIMPSON**
Strong-Tie**Seismic and Hurricane Ties (cont.)**

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_F = 1.15$)					
					D.Fir-L			S-P-F		
		To Rafter/Truss	To Plates	To Studs	Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(6) 8d x 1½"	(4) 8d	—	740	685	300	680	485	216
					3.29	3.05	1.33	3.02	2.16	0.96
SS H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(6) 8d x 1½"	830	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	180	180	755	160	160
					3.58	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	160	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	285	615	125	190
					3.29	0.80	1.18	2.74	0.56	0.86
H6	16	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	670	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS H8 ²	18	(5) 10d x 1½"	(5) 10d x 1½"	—	1120	—	—	1025	—	—
					4.98	—	—	4.56	—	—
SS H10A ³	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	565	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.54	1.36
H10A-2	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1835	1275	430	1645	880	305
					8.16	5.67	1.91	7.32	3.91	1.36
H10S ^{2,3}	18	(8) 8d x 1½"	(8) 8d x 1½"	(8) 8d	1465	795	315	1040	565	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2½"	(6) 16d x 2½"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	[1] (12) 8d x 1½"	(13) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
		[2] (12) 8d x 1½"	(15) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
TSP	16	(9) 10d x 1½"	(6) 10d x 1½"	—	1285	440	—	920	310	—
					5.76	1.96	—	4.09	1.38	—
		(9) 10d x 1½"	(6) 10d	—	1560	440	—	1105	310	—
					6.94	1.96	—	4.92	1.38	—

- Factored resistances have been increased 16% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 595 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain banding of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (638 kN) D.Fir-L and 1015 lb. (451 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 6/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1½" nails into the top plates and (3) 8d x 1½" nails into the lowest three flange holes into the truss bottom chord is 495 lb. (2.20 kN).
- Nails: 16d x 2½" = 0.162" dia. x 2½" long, 10d = 0.148" dia. x 3" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long, 8d x 1½" = 0.131" dia. x 1½" long. See pp. 27-28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

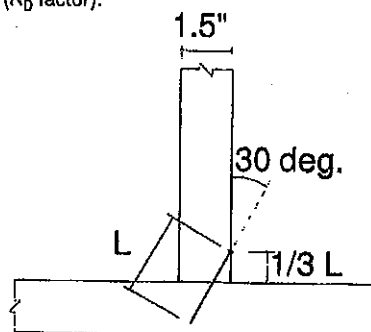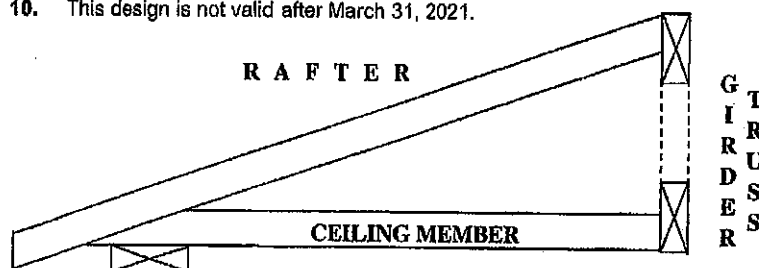

TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (In)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019

PEO
Certificate No. 10869485



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind** or **earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

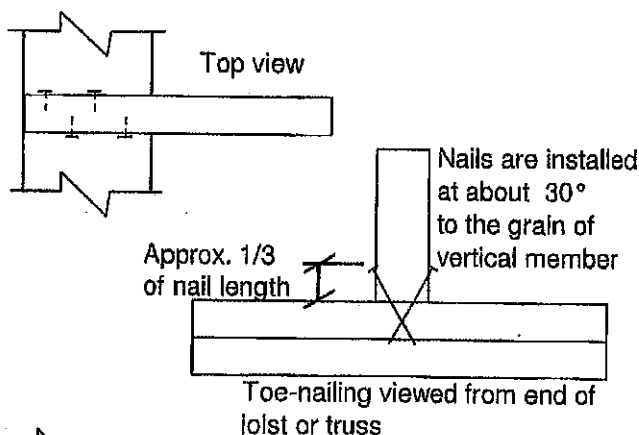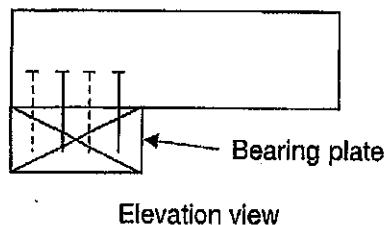

Toe-nailing on 2x4 Bearing Plate

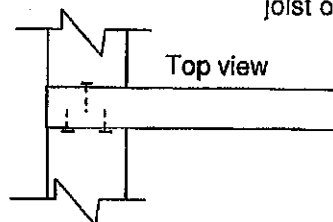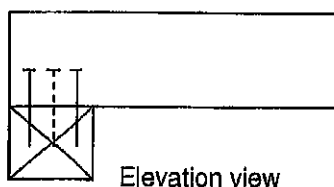

MiTek®


MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7




December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint, unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/4" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm. (Drawings not to scale)

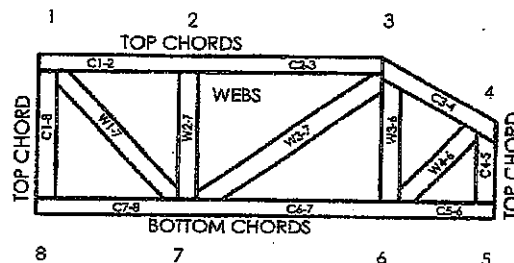

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MIT-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane of joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing of 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected ovetop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

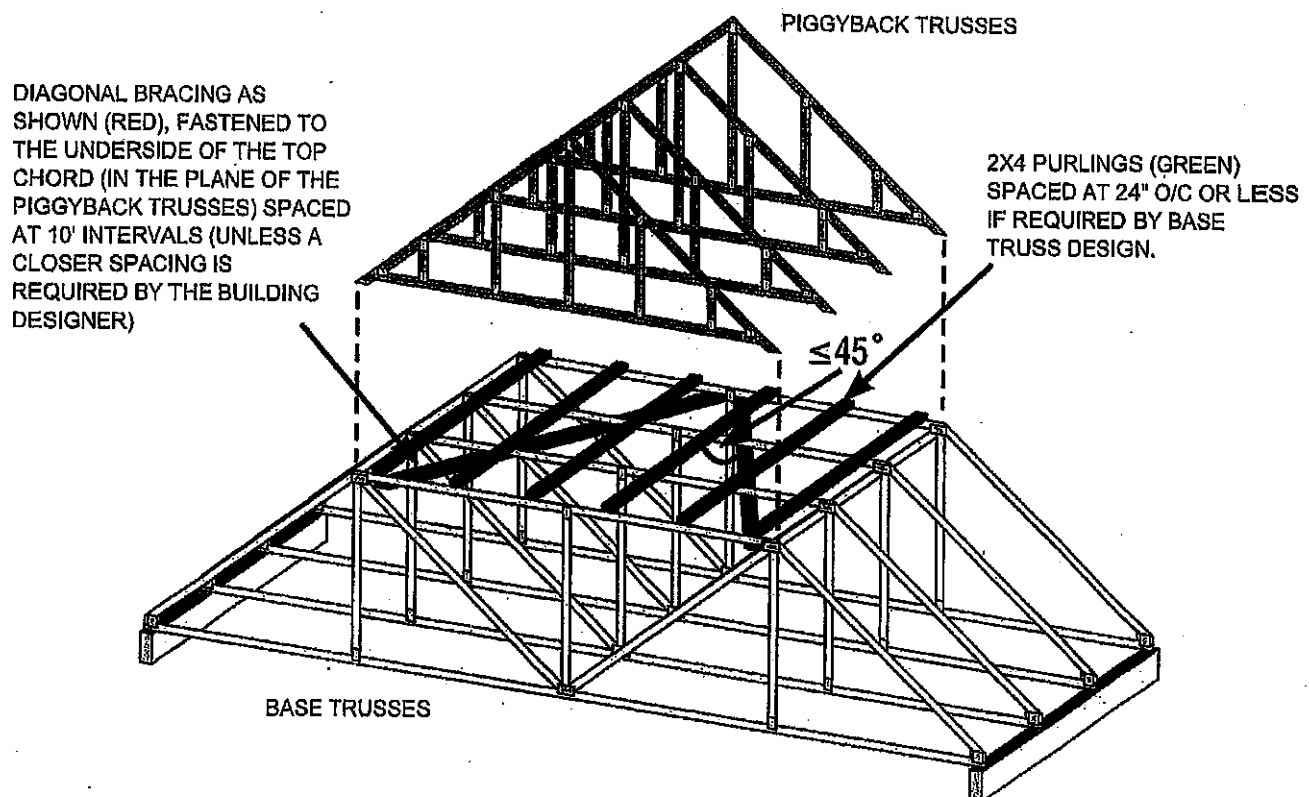


NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1900213

Feb 09, 2018