


32-09-00

44-08-00

1-00-00 6-04-00

ROOF PITCH 6/12 UNLESS NOTED

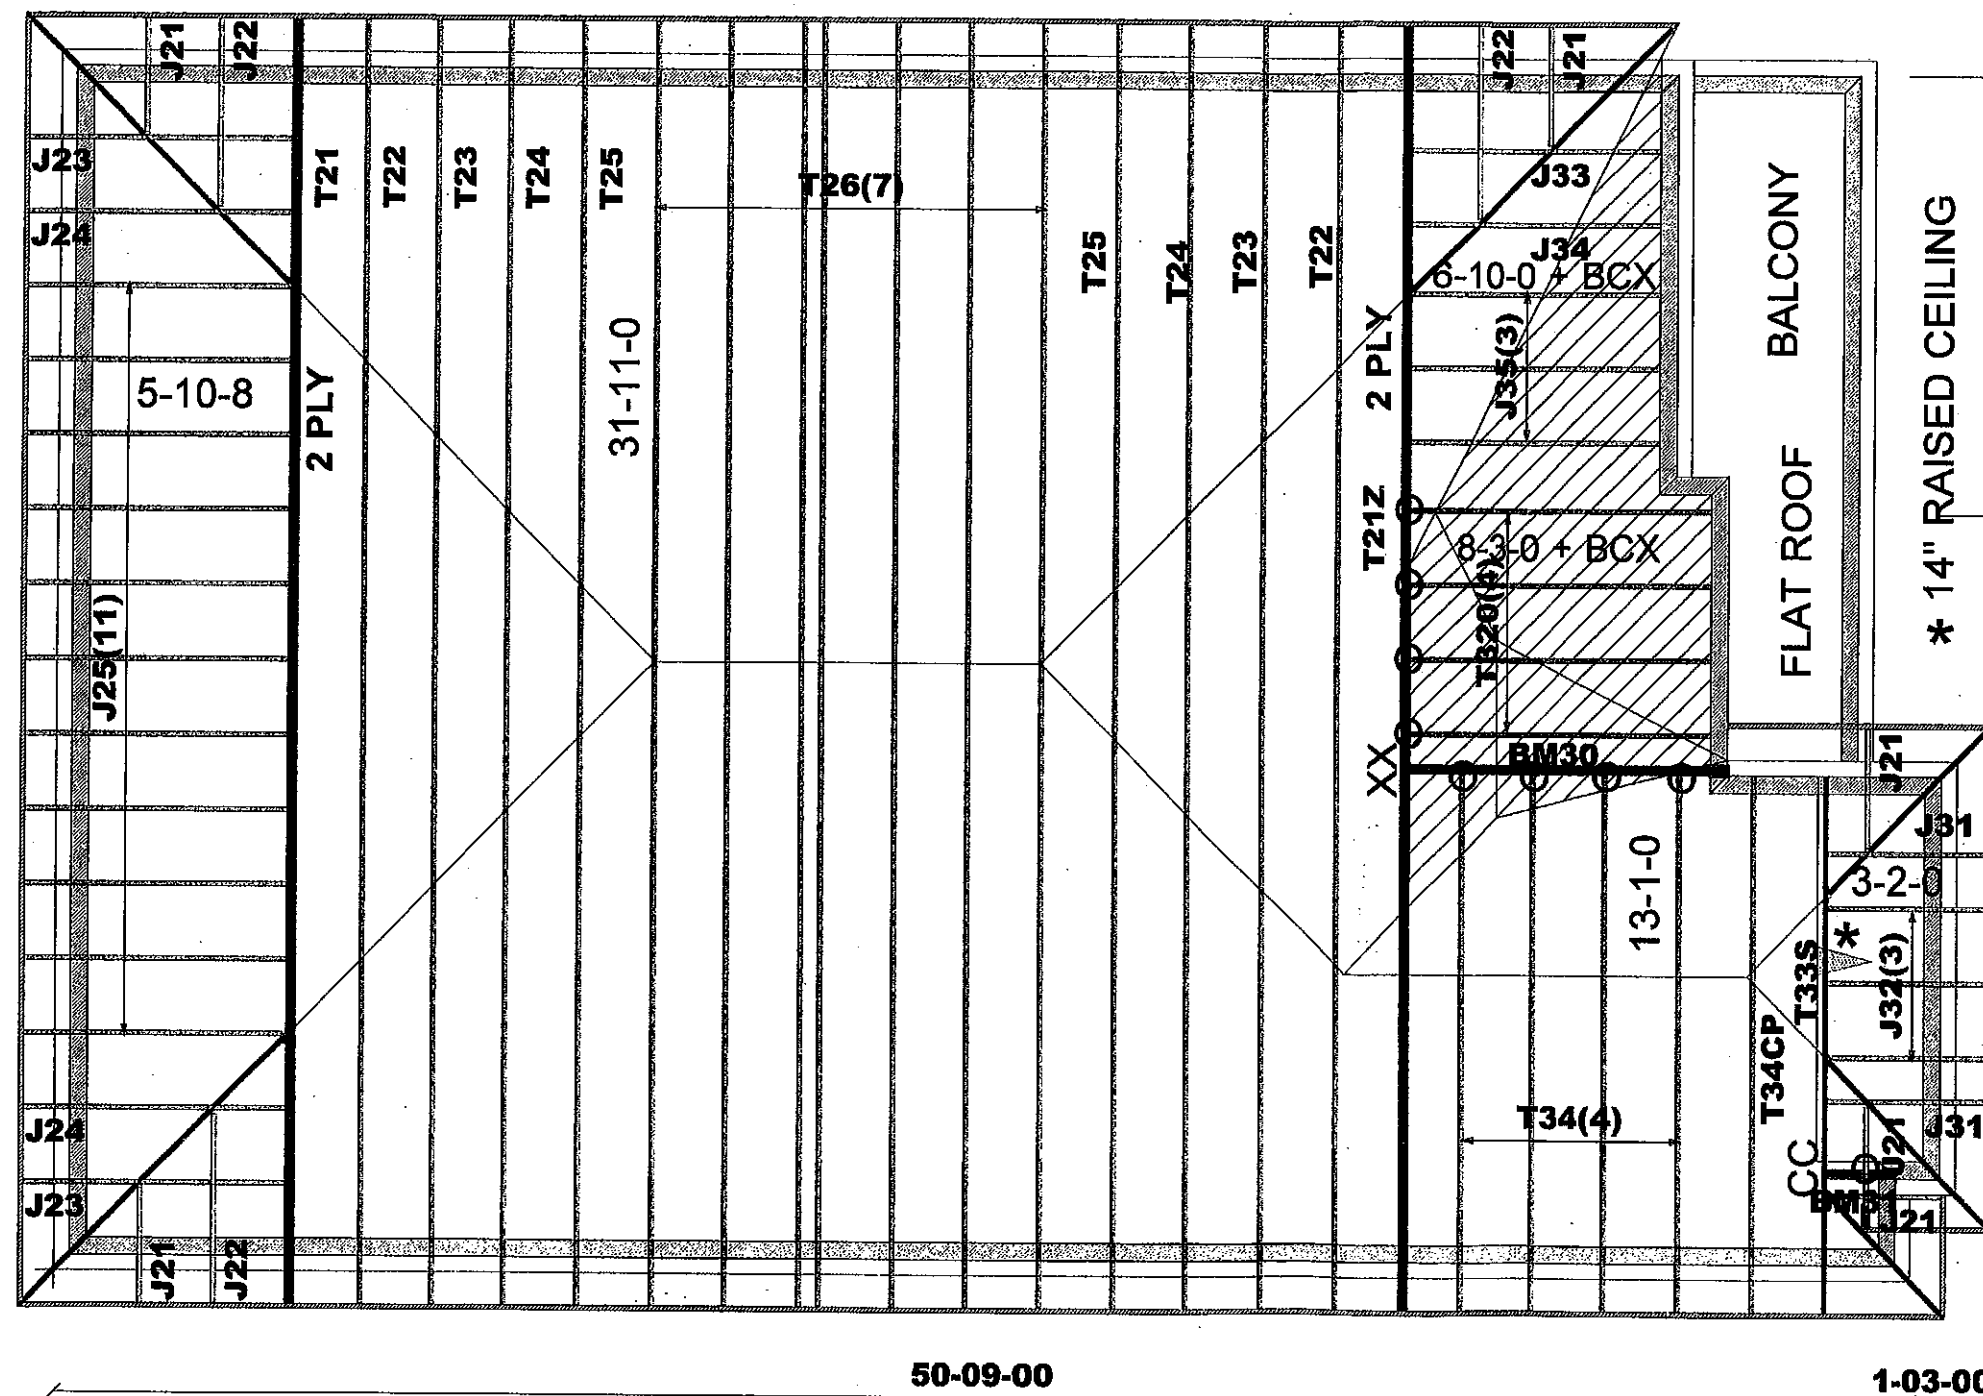

* 14" RAISED CEILING

ALL CONV. FRAMING TO CONFORM WITH PART 9 OF O.B.C.2012
(2019 AMENDMENT) ROOF RAFTERS THAT CROSS MEET OVER TRUSSES
TO BE 2X4SPF @ 24" O.C. WITH A 2X4 VERT. POST TO THE TRUSS
UNDER NEATH AT EACH CROSS PT. VERT. POST LONGER THAN 6"
TO HAVE LATERAL BRACING SO THAT THE DISTANCE BETWEEN
END PT. & BETWEEN ROWS OF BRACING DOES NOT EXCEED 6"

7-07-00

11-07-00

2-04-00

ASPHALT SHINGLES
12" FINISHED OH.
R.T.M.C.
2X6 EXTERIOR WALLS
2X6 FASCIA BOARD

HARDWARE:
LUS24 - (O)
HUSC26-2 - (CC)
HGUS26-2 - (XX)

DENOTES
CONV.
FRAMING

CITY OF HAMILTON BUILDING DIVISION Planning & Development Department	
FEB 10 2021	
REC'D BY	DATE
REF'D TO	DATE

DESIGN CONFORMS
WITH O.B.C.2012 PART 9
(2019 AMENDMENT)
DESIGN LOADS:
SNOW LOAD 25.6 PSF
TC DEAD 6 PSF
BC LIVE 0 PSF
BC DEAD 7.4 PSF

BM30, BM31 = 2-2X10



Job Track: **51225**
Plan Log: **202404**
Layout ID: **408165**

Builder / Location:
GREEN PARK HOMES / WATERDOWN

Project: **RUSSELL GARDENS PH.3**

Date: 2020-05-11 Sales: **Mario DiCano**

Designer: **AC/**

Model / Elevation:
VALLEYCREEK 4/3

LOT 285

Mike ver 8.3.1.215

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: VALLEYCREEK 4
 Lot #: 285
 Elevation: 3

Job Track: 51225
 PlanLog: 202404
 Layout ID: 408165
 Ref #
 Page: 1 of 2
 Date: 04-15-2020
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T21 Hip Girder	6 /12	31-11-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	310.75 194.00		
	1 2-ply	T212 Hip Girder	6 /12	31-11-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	310.75 194.00		
	2	T22 Hip	6 /12	31-11-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	259.03 161.67		
	2	T23 Hip	6 /12	31-11-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	258.25 161.33		
	2	T24 Hip	6 /12	31-11-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	271.21 168.33		
	2	T25 Hip	6 /12	31-11-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	262.57 165.00		
	7	T26 Hip	6 /12	31-11-00	9-01-12	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	904.65 565.83		
	4	T320 Roof Special	6 /12	8-03-00	4-01-04	2 x 4		1-00-00 4-01-04	119.18 76.00		
	1	T33S Hip Girder	6 /12	13-01-00	3-11-00	2 x 4	1-03-08	1-02-00 1-02-00	54.31 36.00		
	4	T34 Common	6 /12	13-01-00	5-00-04	2 x 4	1-03-08	1-02-00 2-04-00	206.67 135.33		
	1	T34CP Hip	6 /12	13-01-00	4-11-00	2 x 4	1-03-08	1-02-00 2-04-00	51.56 33.83		
	6	J21 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	42.13 28.00		
	3	J22 Jack-Open	6 /12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	28.71 18.00		
	2	J23 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	23.16 14.67		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: VALLEYCREEK 4
 Lot #: 285
 Elevation: 3

Job Track: 51225
 PlanLog: 202404
 Layout ID: 408165
 Ref #
 Page: 2 of 2
 Date: 04-15-2020
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	J24 Jack-Open	6 /12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	28.26 17.33		
	11	J25 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	184.74 117.33		
	2	J31 Jack-Open	6 /12	1-10-15	2-01-08	2 x 4	1-03-08 1-03-01	1-02-00 2-01-08	17.31 12.00		
	3	J32 Jack-Open	6 /12	3-02-00	2-09-00	2 x 4	1-03-08	1-02-00 2-09-00	30.76 22.00		
	1	J33 Jack-Open	6 /12	6-10-00	2-01-08	2 x 4		8-04 4-01-04	13.22 8.67		
	1	J34 Jack-Open	6 /12	6-10-00	3-01-08	2 x 4		8-04 4-01-04	15.77 10.00		
	3	J35 Jack-Open	6 /12	6-10-00	4-01-04	2 x 4		8-04 4-01-04	67.97 45.00		

TOTAL # TRUSS= 63

TOTAL BFT OF ALL TRUSSES= 2184.32 BFT.

TOTAL WEIGHT OF ALL TRSSES 3460.95 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
9	Hardware	LUS24	
1	Hardware	HGUS26-2	
1	Hardware	HUSC26-2	

TOTAL NUMBER OF
ITEMS=

11

Structural component only $\frac{1}{2}$
DWG# T-2006468 CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408163	T1	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2018 MITek Industries, Inc. Fri Apr 17 08:46:35 2020 Page 2
ID:KIHNL7kIAuBVUgBrQW7E8zls6v-tmv3EgsgdlkXgcTINYXUUGDwL2ldjw 1K2addzPX

PLATES (table in inches)


JT	TYPE	PLATES	W	LEN	Y	X
V	BMW+u	MT20	3.0	6.0		
Y	BMV1+p	MT20	3.0	6.0		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
D	5-10-8	-584	-584	---	FRONT	VERT	TOTAL	---	C1
F	15-11-8	-178	-178	---	FRONT	VERT	TOTAL	---	C1
G	17-11-12	-178	-178	---	FRONT	VERT	TOTAL	---	C1
I	26-0-8	-584	-584	---	FRONT	VERT	TOTAL	---	C1
N	28-11-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1
P	25-11-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1
R	19-11-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1
S	15-11-8	-36	-36	---	FRONT	VERT	TOTAL	---	C1
T	11-11-4	-36	-36	---	FRONT	VERT	TOTAL	---	C1
V	5-11-4	-36	-36	---	FRONT	VERT	TOTAL	---	C1
X	1-11-4	-36	-36	---	FRONT	VERT	TOTAL	---	C1
Z	7-11-4	-178	-178	---	FRONT	VERT	TOTAL	---	C1
AA	9-11-4	-178	-178	---	FRONT	VERT	TOTAL	---	C1
AB	11-11-4	-178	-178	---	FRONT	VERT	TOTAL	---	C1
AC	13-11-4	-178	-178	---	FRONT	VERT	TOTAL	---	C1
AD	19-11-12	-178	-178	---	FRONT	VERT	TOTAL	---	C1
AE	21-11-12	-178	-178	---	FRONT	VERT	TOTAL	---	C1
AF	23-11-12	-178	-178	---	FRONT	VERT	TOTAL	---	C1
AG	3-11-4	-36	-36	---	FRONT	VERT	TOTAL	---	C1
AH	7-11-4	-36	-36	---	FRONT	VERT	TOTAL	---	C1
AI	9-11-4	-36	-36	---	FRONT	VERT	TOTAL	---	C1
AJ	13-11-4	-36	-36	---	FRONT	VERT	TOTAL	---	C1
AK	17-11-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1
AL	21-11-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1
AM	23-11-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1
AN	27-11-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

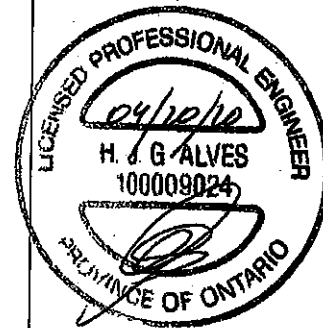


Structural component only
DWG# T-2006468

72

JOB NAME 408163	TRUSS NAME T1Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Fri Apr 17 08:48:38 2020 Page 1
 ID:KIHNL7kAuBVUgBrpQW7E8zls6y-LzTSS0eOCosOImTf643m0hpSgkKpM5c8G_o683zPDXH
 1-3-8 0-0 3-0-8 3-0-8 2-10-0 5-10-8 5-1-2 10-11-10 4-11-14 15-11-8 4-11-14 20-11-6 5-1-2 28-0-8 2-10-0 28-10-8 3-0-8 31-11-0 33-2-8
 Scale = 1:52.8

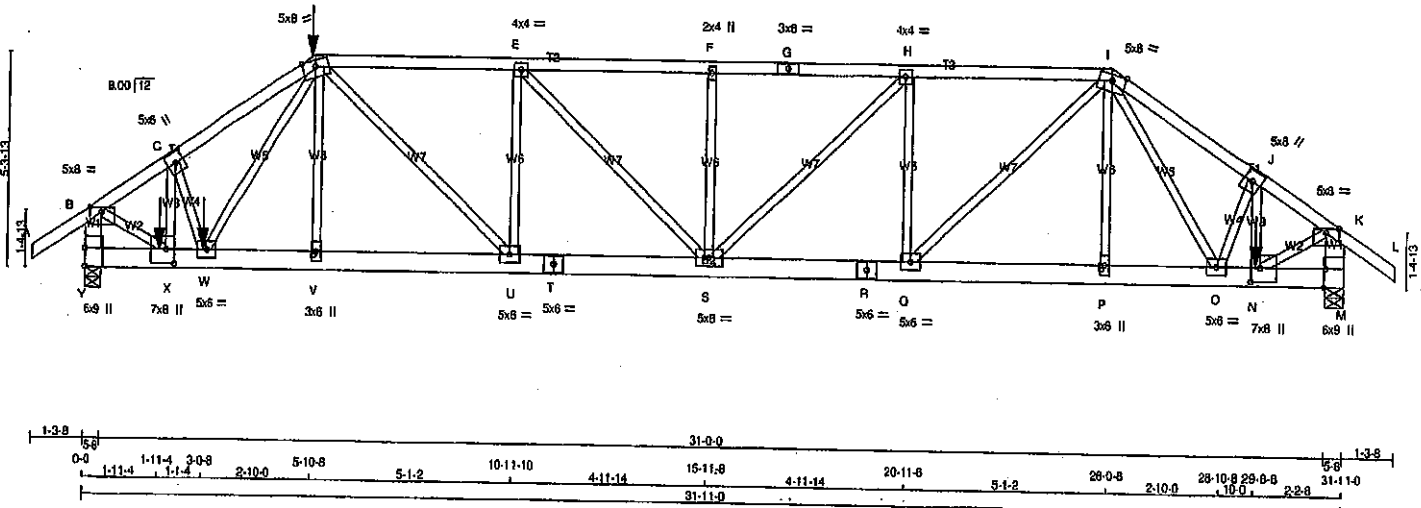

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4 DRY	No.2	SPF
D - G	2x4 DRY	No.2	SPF
G - I	2x4 DRY	No.2	SPF
I - L	2x4 DRY	No.2	SPF
Y - B	2x6 DRY	No.2	SPF
M - K	2x6 DRY	No.2	SPF
Y - T	2x6 DRY	No.2	SPF
T - R	2x6 DRY	No.2	SPF
R - M	2x6 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
EXCEPT			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-D	12	SIDE(61.0)
D-G	12	SIDE(61.0)
G-I	12	TOP
I-L	12	TOP
Y-B	12	TOP
M-K	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
Y-T	12	SIDE(915.6)
T-R	12	TOP
R-M	12	SIDE(915.6)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	8	SIDE(391.7)
G-X	2	
J-N	2	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3.0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (Table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMVW-p	MT20	5.0	8.0	1.25 4.00
C TMVW-w	MT20	5.0	6.0	
D TTWWW-m	MT20	5.0	8.0	Edge
E TMVW-t	MT20	4.0	4.0	
F TMVW-w	MT20	2.0	4.0	
G TS-t	MT20	3.0	6.0	
H TMVW-t	MT20	4.0	4.0	
I TTWWW-m	MT20	5.0	8.0	Edge
J TMVW-t	MT20	5.0	6.0	
K TMVW-p	MT20	5.0	8.0	1.25 4.00
M BMV1-t	MT20	6.0	9.0	Edge 0.50
N BMVW-t	MT20	7.0	8.0	4.25 2.50
O, Q, U, W				
O BMVW-t	MT20	5.0	6.0	
P BMVW-w	MT20	3.0	6.0	
R BS-t	MT20	5.0	6.0	
S BMVW-t	MT20	5.0	8.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
Y	4889	0	4889	0	0
M	6873	0	6873	0	0

UNFACTORED REACTIONS

1ST CASE MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND
Y	3433	2308	0	0	0
M	4850	3240	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Y, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.67 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO			
A-B	0/35	-91.8	-91.8
B-C	-4948/0	-91.8	-91.8
C-D	-5328/0	-91.8	-91.8
D-E	-4737/0	-91.8	-91.8
E-F	-5022/0	-91.8	-91.8
F-G	-5022/0	-91.8	-91.8
G-H	-5022/0	-91.8	-91.8
H-I	-4787/0	-91.8	-91.8
I-J	-6115/0	-91.8	-91.8
J-K	-8704/0	-91.8	-91.8
K-L	0/35	-91.8	-91.8
L-M	-4819/0	0.0	0.0
M-K	-6463/0	0.0	0.0
WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO			
X-C	-1315/0	0.12	0.12
V-D	0/363	0.04	0.04
D-U	0/1211	0.15	0.15
U-E	-798/0	0.18	0.18
E-S	0/401	0.06	0.06
S-F	-420/0	0.09	0.09
S-H	0/332	0.04	0.04
Q-H	-747/0	0.15	0.15
Q-I	0/1148	0.14	0.14
P-I	0/233	0.03	0.03
N-J	0/1399	0.17	0.17
B-X	0/4525	-0.58	-0.58
N-K	0/6121	0.78	0.78
C-W	0/854	0.11	0.11
W-D	0/1148	0.14	0.14
O-J	-1448/0	0.14	0.14
I-O	0/2298	0.28	0.28

FACTORED CONCENTRATED LOADS (LBS)					
JT	LOC.	LC1	MAX	MAX+	FACE
D	5-10-8	399	399	---	BACK
N	28-8-8	5011	5011	---	BACK
W	3-0-8	2525	2525	---	BACK
X	1-11-4	38	38	---	BACK

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.0%/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.06")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.08")
CALCULATED VERT. DEFL.(TL) = L/999 (0.20")

CSI: TC=0.31/1.00 (E-F:1), BC=0.68/1.00 (N-O:1), WB=0.78/1.00 (K-N:1), SS=0.25/1.00 (N-O:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	518	354	1657
	768	1987	1659

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

GRIP=0.67 (B) (INPUT = 0.90)

METAL=0.72 (X) (INPUT = 1.00)

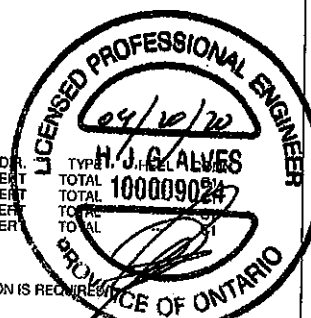

Structural component only
DWG# T-2006469

CONTINUED ON PAGE 2


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408163	T1Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 08:46:36 2020 Page 2
ID:KIHNL7kAuBVUqBrQW7EBzls6y-LzTSS0elOcsOImTls43m0hpSgkKqM5c8G o893zPIXH

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
T	BS-t	MT20	5.0	6.0		
V	BMW+w	MT20	3.0	6.0		
X	BMWW+t	MT20	7.0	8.0	4.25	2.50
Y	BMW1+t	MT20	6.0	9.0	5.50	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

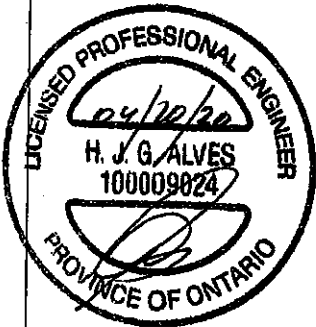


3/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408163	T2	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Verion 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:48:37 2020 Page 1
ID:KIHNL7kAuBVUgBrpQW7E8zls6y-p80q/Lfw9w_Fw2sPnb7ZvMav8K55XcdHueXhivZpIXG

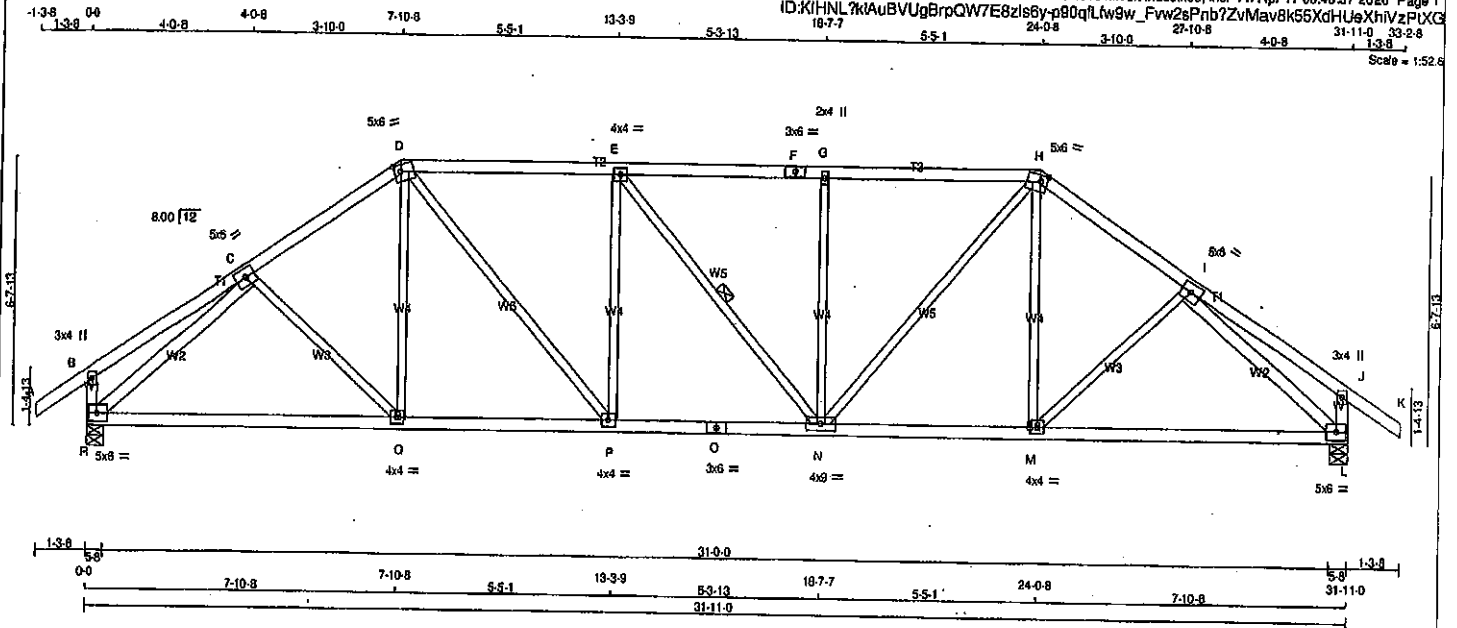

TOTAL WEIGHT = 2 X 142 = 283 lb

LUMBER	N. L. G. A. RULES	CHOROS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - K	2x4	DRY	No.2	SPF	
R - B	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
R - O	2x4	DRY	No.2	SPF	
O - L	2x4	DRY	No.2	SPF	

ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
R - G	2x4	DRY	No.2	SPF	
I - L	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0			
C	TMVW-1	MT20	5.0	5.0	2.00	2.00	
D	TMVW-1	MT20	4.0	4.0			
F	TS-1	MT20	3.0	5.0			
G	TMVW-1	MT20	2.0	4.0			
H	TMVW-1	MT20	5.0	5.0	2.00	2.00	
I	TMVW-1	MT20	5.0	5.0			
J	TMV+p	MT20	3.0	4.0			
L	BMVW-1	MT20	5.0	5.0			
M, P, Q							
N	BMVW-1	MT20	4.0	4.0			
O	BS-1	MT20	4.0	5.0			
R	BMVW-1	MT20	5.0	5.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG	
JT VERT	1885	0	0	5-8
R VERT	1885	0	0	5-8
L VERT	1885	0	0	5-8

UNFACTORED REACTIONS							
	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT							
R	1331	887 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0
L	1331	887 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.12 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO	FROM	TO	FROM	TO	FROM	TO	FROM	TO	FROM
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	C-Q	0 / 57	0.02 (4)	
B-C	0 / 22	-91.8	-91.8	0.22 (1)	10.00	Q-D	0 / 145	0.05 (4)	
C-D	-2020 / 0	-91.8	-91.8	0.28 (1)	4.49	D-P	0 / 814	0.18 (1)	
D-E	-2191 / 0	-91.8	-91.8	0.47 (1)	4.12	P-E	-533 / 0	0.39 (1)	
E-F	-2189 / 0	-91.8	-91.8	0.47 (1)	4.12	E-N	-2 / 0	0.00 (1)	
F-G	-2189 / 0	-91.8	-91.8	0.47 (1)	4.12	N-G	-533 / 0	0.39 (1)	
G-H	-2189 / 0	-91.8	-91.8	0.47 (1)	4.13	H-H	0 / 811	0.18 (1)	
H-I	-2020 / 0	-91.8	-91.8	0.28 (1)	4.49	M-H	0 / 147	0.05 (4)	
I-J	0 / 22	-91.8	-91.8	0.22 (1)	10.00	M-I	0 / 57	0.02 (4)	
J-K	0 / 35	-91.8	-91.8	0.12 (1)	10.00	R-C	-2272 / 0	0.77 (1)	
R-B	-265 / 0	0.0	0.0	0.03 (1)	7.81	I-L	-2273 / 0	0.77 (1)	
L-J	-265 / 0	0.0	0.0	0.03 (1)	7.81				
R-Q	0 / 1655	-18.5	-18.5	0.40 (1)	10.00				
Q-P	0 / 1662	-18.5	-18.5	0.40 (1)	10.00				
P-O	0 / 2191	-18.5	-18.5	0.41 (1)	10.00				
O-N	0 / 2191	-18.5	-18.5	0.41 (1)	10.00				
N-M	0 / 1682	-18.5	-18.5	0.41 (1)	10.00				
M-L	0 / 1655	-18.5	-18.5	0.40 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (1.06")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL) = L/380 (1.06")
CALCULATED VERT. DEFL.(TL) = L/999 (0.16")

CSK TC=0.47/1.00 (D-E:1), BC=0.41/1.00 (N-P:1), WB=0.77/1.00 (H:1), SS=0.23/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JT GRIP = 0.86 (D) (INPUT = 0.90)
R-C METAL = 0.73 (O) (INPUT = 1.00)

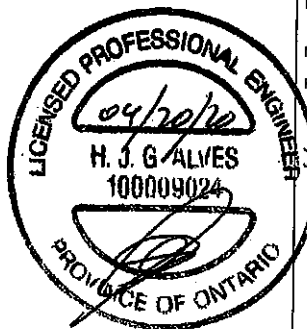


Structural component only
DWG# T-2006470

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408163	T3	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 8 Oct 29 2019 MTEK Industries, Inc. Fri Apr 17 08:48:39 2020 Page 1
ID:KIHLNL7kAuBVUpBrpQW7E8zls6y-mY8a41hAhXEy9ECEXCdTeKRw5yQbZQEay0omOzPiXE
1-3-8 0-0 5-0-8 5-0-8 4-10-0 9-10-8 6-1-0 15-11-8 6-1-0 22-0-8 4-10-0 26-10-8 5-0-8 31-11-0 33-2-8 1-3-8
Scale = 1:52.6

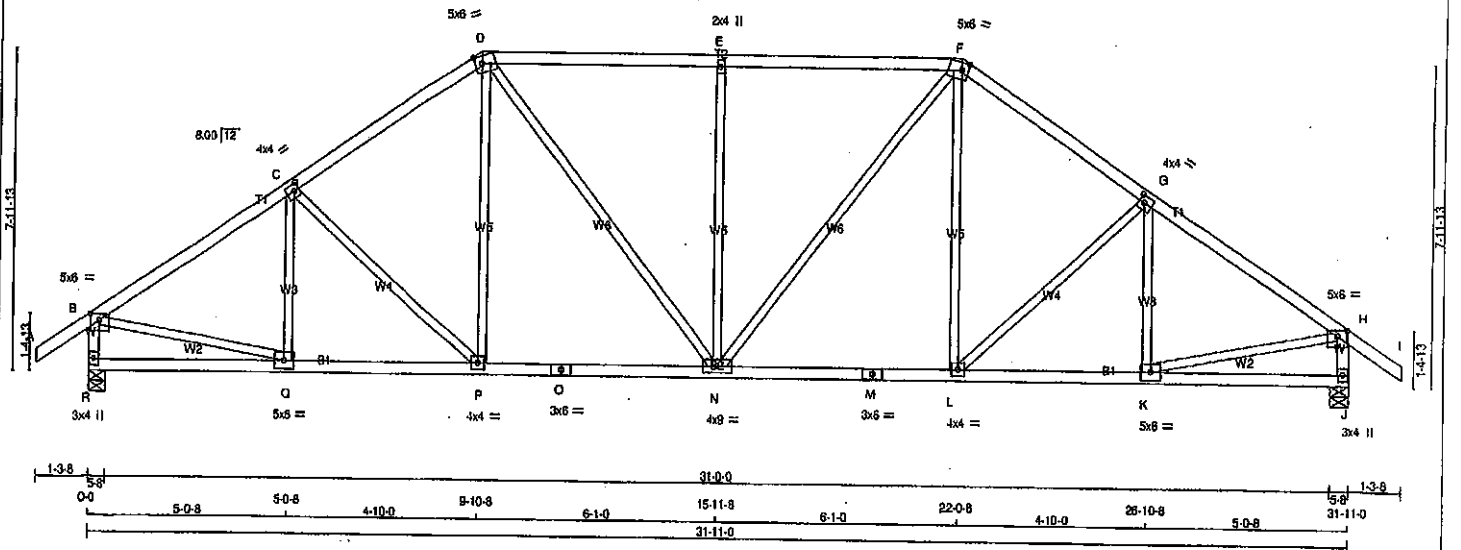

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - F	2x4	DRY	No.2	SPF		
F - I	2x4	DRY	No.2	SPF		
R - B	2x4	DRY	No.2	SPF		
J - H	2x4	DRY	No.2	SPF		
R - O	2x4	DRY	No.2	SPF		
O - M	2x4	DRY	No.2	SPF		
M - J	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						
DRY: SEASONED LUMBER.						

PLATES (table is in inches)							
JT	TYPE	PLATES	W	LEN	Y	X	
B	TMVW-p	MT20	5.0	8.0	1.75	3.00	
C	TMVW-t	MT20	4.0	4.0	2.00	1.50	
D	TTWW-m	MT20	5.0	6.0	2.25	2.00	
E	TMVW-w	MT20	2.0	4.0			
F	TTWW-m	MT20	5.0	8.0	2.25	2.00	
G	TMVW-i	MT20	4.0	4.0	2.00	1.50	
H	TMVW-p	MT20	5.0	8.0	1.75	3.00	
J	BMV1-p	MT20	3.0	4.0			
K	BMVW-i	MT20	5.0	8.0			
L	BMVW-t	MT20	4.0	4.0			
M	BS-t	MT20	3.0	8.0			
N	BMVWW-t	MT20	4.0	8.0			
O	BS-t	MT20	3.0	6.0			
P	BMVW-i	MT20	4.0	4.0			
Q	BMVW-t	MT20	5.0	8.0			
R	BMV1-p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	DOWN	HORIZ	UPLIFT
JT	VERT	HORIZ	DOWN	HORIZ
R	1885	0	1885	0
J	1885	0	1885	0

UNFACTORED REACTIONS							
	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW.	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	1331	887/0	0/0	0/0	0/0	444/0	0/0
J	1331	887/0	0/0	0/0	0/0	444/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.35 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS						WEBS					
MEMB.		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD		MAX	MEMB.		MAX. FACTORED FORCE (LBS)	MAX		
FR-TO			FROM	TO	CSI (LC)	FR-TO			FROM	TO	
A-B	0/35	-91.8	-91.8	0.12 (1)	10.00	Q-C	-280/0	0.09 (1)			
B-C	-2071/0	-91.8	-91.8	0.35 (1)	4.39	C-P	-244/0	0.20 (1)			
C-D	-1915/0	-91.8	-91.8	0.34 (1)	4.55	P-D	0/267	0.06 (1)			
D-E	-1885/0	-91.8	-91.8	0.49 (1)	4.35	D-N	0/508	0.11 (1)			
E-F	-1885/0	-91.8	-91.8	0.49 (1)	4.35	N-E	-684/0	0.83 (1)			
F-G	-1915/0	-91.8	-91.8	0.34 (1)	4.55	N-F	0/508	0.11 (1)			
G-H	-2071/0	-91.8	-91.8	0.35 (1)	4.39	L-F	0/267	0.08 (1)			
H-I	0/35	-91.8	-91.8	0.12 (1)	10.00	L-G	-244/0	0.20 (1)			
I-B	-1844/0	0.0	0.0	0.19 (1)	6.16	K-G	-280/0	0.09 (1)			
J-H	-1844/0	0.0	0.0	0.19 (1)	6.16	B-Q	0/1787	0.40 (1)			
						K-H	0/1787	0.40 (1)			
R-Q	0/0	-18.5	-18.5	0.10 (4)	10.00						
Q-P	0/1747	-18.5	-18.5	0.34 (1)	10.00						
P-O	0/1570	-18.5	-18.5	0.32 (1)	10.00						
O-N	0/1570	-18.5	-18.5	0.32 (1)	10.00						
N-M	0/1570	-18.5	-18.5	0.32 (1)	10.00						
M-L	0/1570	-18.5	-18.5	0.32 (1)	10.00						
L-K	0/1747	-18.5	-18.5	0.34 (1)	10.00						
K-J	0/0	-18.5	-18.5	0.10 (4)	10.00						

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.06")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (1.06")
CALCULATED VERT. DEFL.(TL) = L/999 (0.16")

CSI: TC=0.49/1.00 (D-E:1), BC=0.34/1.00 (P-Q:1), WB=0.83/1.00 (E-N:1), SS=0.27/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.86 (Q) (INPUT = 0.90)
JSI METAL = 0.51 (O) (INPUT = 1.00)

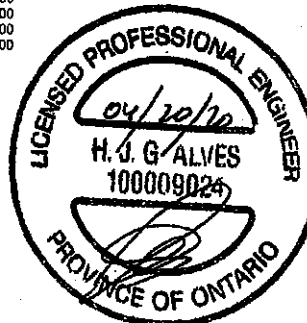

Structural component only
DWG# T-2008471

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408163	T4	11	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2018 Mitek Industries, Inc. Fri Apr 17 08:48:40 2020 Page 1					
ID:KIHNL7K1AuBVUgBrpQW7E8zls6y-EkiyHNhoSrNpmNrR5w8iBX_4IMmZlxAJAcmlLqzPtXD					
Scale = 1:54.5					

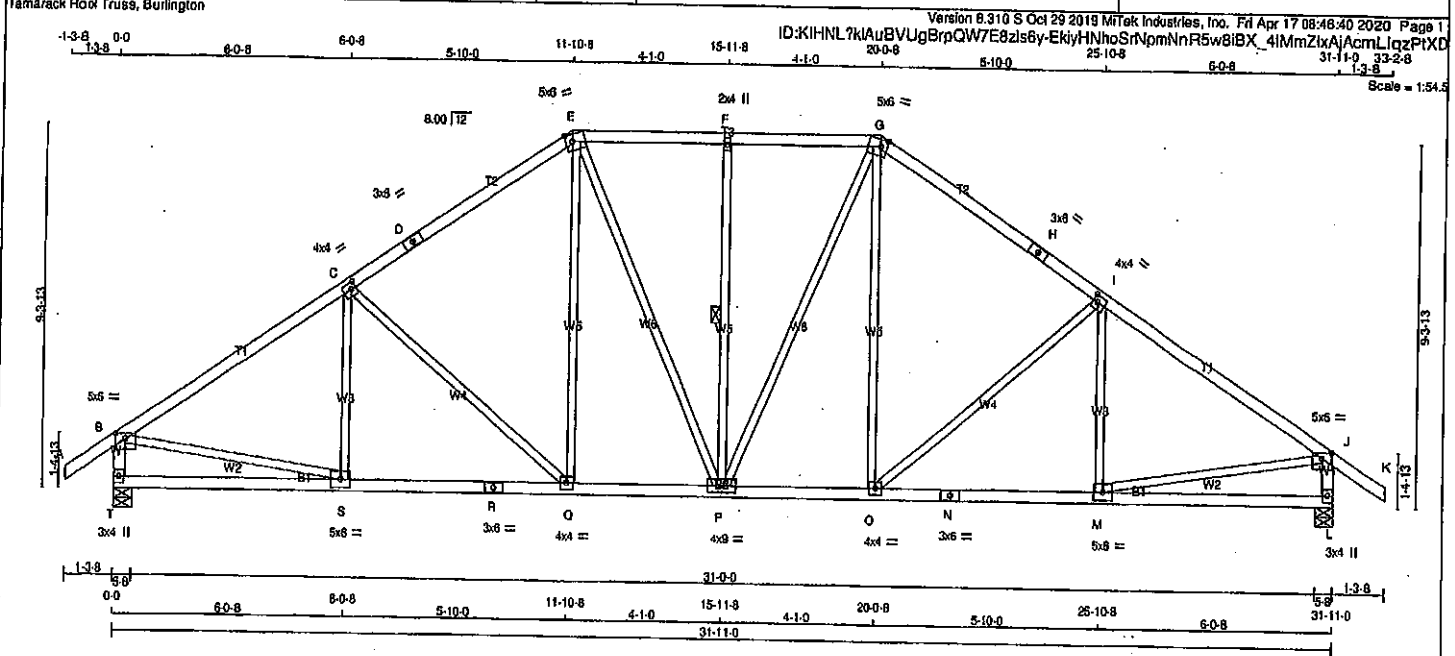

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
T - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
T - R	2x4	DRY	No.2
R - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMVW-p	MT20	5.0	8.0	1.75 3.00
C TMVW-i	MT20	4.0	4.0	2.00 1.50
D TS-i	MT20	3.0	8.0	
E TTMW-m	MT20	5.0	8.0	2.25 2.00
F TMVW-w	MT20	2.0	4.0	
G TTMW-m	MT20	5.0	8.0	2.25 2.00
H TS-i	MT20	3.0	8.0	
I TMVW-i	MT20	4.0	4.0	2.00 1.50
J TMVW-p	MT20	5.0	8.0	1.75 3.00
L BMV1-p	MT20	3.0	4.0	
M BMVW-i	MT20	5.0	8.0	
N BS-i	MT20	3.0	8.0	
O BMVW-i	MT20	4.0	4.0	
P BMVW-w	MT20	4.0	9.0	
Q BMVW-i	MT20	4.0	4.0	
R BS-i	MT20	3.0	8.0	
S BMVW-i	MT20	5.0	8.0	
T BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	VERT	DOWN	IN-SX	IN-SX
T	1885	0	1885	0	5-8
L	1885	0	1885	0	5-8

UNFACTORED REACTIONS		1ST LCASE	MAX./MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
T	1331	887/0	0/0
L	1331	887/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.16 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0/35	S-C	-194/35
B-C	-2097/0	C-Q	-420/0
C-D	-1790/0	Q-E	0/389
D-E	-1790/0	E-P	0/280
E-F	-1578/0	P-F	-449/0
F-G	-1578/0	G-H	0/280
G-H	-1790/0	H-I	0/389
H-I	-1790/0	I-J	-420/0
I-J	-2097/0	J-K	-194/35
J-K	0/-35	K-L	0/1803
L-B	-1839/0	B-S	0/1803
L-J	-1839/0	M-J	0/1803
T-S	0/0		
S-R	0/1775		
R-Q	0/1775		
Q-P	0/1461		
P-O	0/1461		
O-N	0/1775		
N-M	0/1775		
M-L	0/0		

TOTAL WEIGHT = 11 X 151 = 1658 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019

- PART 9 OF CBC 2012 (2019 AMENDMENT)

- CSA 080-08, CSA 080-14

- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.06")

CALCULATED VERT. DEFL. (LL) = L/999 (0.08")

ALLOWABLE DEFL. (TL) = L/360 (1.06")

CALCULATED VERT. DEFL. (TL) = L/999 (0.14")

CSI: TC=0.53/1.00 (B-C:1), SC=0.38/1.00 (C-S:1),

WB=0.53/1.00 (C-Q:1), SS=0.22/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE (GRIP/DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN


MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


ISI GRIP = 0.84 (B) (INPUT = 0.90)

ISI METAL = 0.57 (N) (INPUT = 1.00)

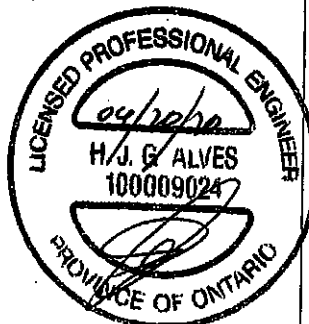

Structural component only
DWG# T-2006472

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408163	T5	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

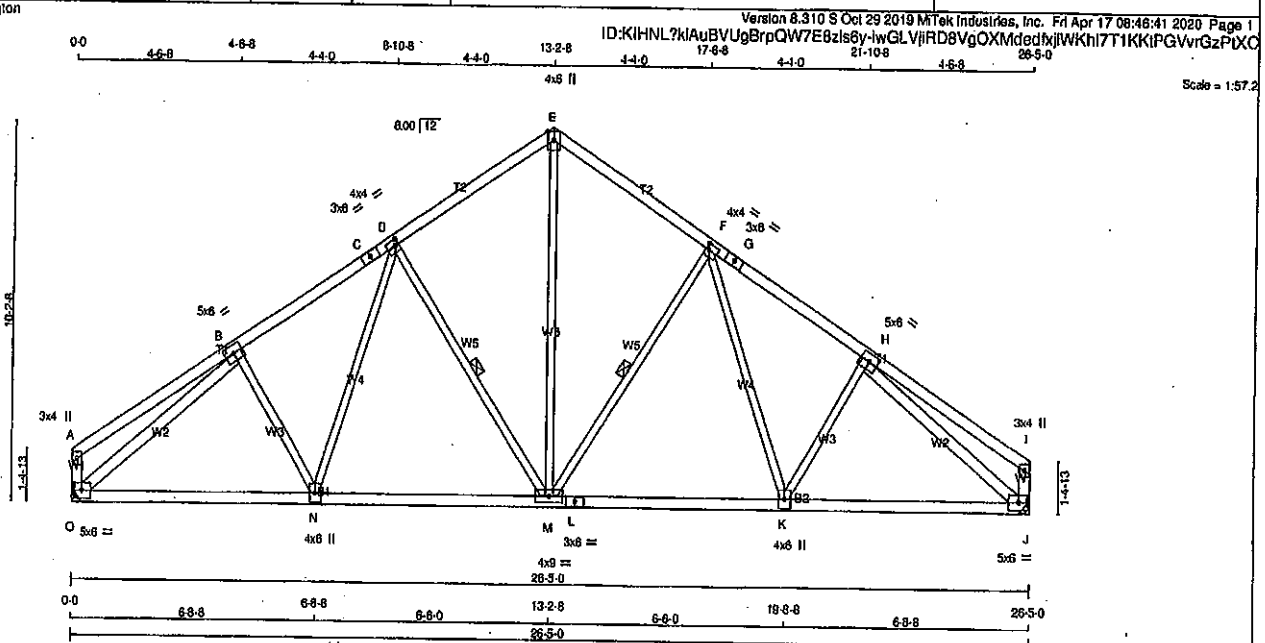

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS			
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
O - A	2x4	DRY	No.2
J - I	2x4	DRY	No.2
O - L	2x4	DRY	No.2
L - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
O - B	2x4	DRY	No.2
H - J	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)				
JT TYPE	PLATES	W	LEN	Y X
A	TMV-p	MT20	3.0	4.0
B	TMWV-t	MT20	5.0	6.0
C	TS-t	MT20	3.0	8.0
D	TMWV-t	MT20	4.0	4.0
E	TTW-p	MT20	4.0	6.0
F	TMWV-t	MT20	4.0	4.0
G	TS-t	MT20	3.0	6.0
H	TMWV-t	MT20	5.0	6.0
I	TMV-p	MT20	3.0	4.0
J	BMWV-t	MT20	5.0	6.0
K	BMWV-t	MT20	4.0	6.0
L	BS-t	MT20	3.0	6.0
M	BMWV-t	MT20	4.0	6.0
N	BMWV-t	MT20	4.0	6.0
O	BMWV-t	MT20	5.0	6.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT VERT	HORZ	DOWN	HORZ	IN-SX		IN-SX	
O	1456	0	1456	0	0	MECHANICAL	
J	1456	0	1456	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT O, J. MINIMUM BEARING LENGTH AT JOINT O = 3-8, JOINT J = 3-8.

UNFACTORED REACTIONS

1ST CASE	MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
O	1030	676 / 0	0 / 0	0 / 0	354 / 0	0 / 0
J	1030	676 / 0	0 / 0	0 / 0	354 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.05 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF P-M, D-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LCI MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LCI MAX (LC)
FR-TO				FR-TO			
A-B	0 / 21	-91.8	-91.8 0.23 (1)	M-E	0 / 985	0.22 (1)	
B-C	-1580 / 0	-91.8	-91.8 0.21 (1)	M-F	-511 / 0	0.23 (1)	
C-D	-1580 / 0	-91.8	-91.8 0.21 (1)	F-K	0 / 226	0.05 (1)	
D-E	-1198 / 0	-91.8	-91.8 0.21 (1)	K-H	-92 / 25	0.03 (1)	
E-F	-1198 / 0	-91.8	-91.8 0.21 (1)	D-M	-511 / 0	0.23 (1)	
F-G	-1580 / 0	-91.8	-91.8 0.21 (1)	N-D	0 / 226	0.05 (1)	
G-H	-1580 / 0	-91.8	-91.8 0.21 (1)	S-N	-92 / 25	0.03 (1)	
H-I	0 / 21	-91.8	-91.8 0.23 (1)	C-B	-1842 / 0	0.79 (1)	
O-A	-164 / 0	0.0	0.0 0.02 (1)	H-J	-1842 / 0	0.79 (1)	
J-I	-164 / 0	0.0	0.0 0.02 (1)				
O-N	0 / 1381	-18.5	-18.5 0.32 (1)				
N-M	0 / 1248	-18.5	-18.5 0.30 (1)				
M-L	0 / 1248	-18.5	-18.5 0.30 (1)				
L-K	0 / 1248	-18.5	-18.5 0.30 (1)				
K-J	0 / 1381	-18.5	-18.5 0.32 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.83")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.83")
CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CSI: TC=0.23/1.00 (H-t), BC=0.32/1.00 (J-K), WB=0.79/1.00 (H-J), SS=0.16/1.00 (H-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (OR) Y	SHEAR (PL)	SECTION (PL)
(PSI)	(PSI)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1887 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (M) (INPUT = 0.90)
JSI METAL= 0.46 (H) (INPUT = 1.00)

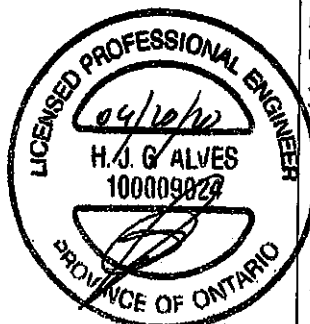


Structural component only
DWG# T-2008473

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408163	T6	2	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Fri Apr 17 08:46:43 2020 Page 1
ID:KIHNL?kIAuBVUgBrpQW7E8z86y-eJO5wPKhlmOerV0m2hPpAcerRZrVPvAIZ_?v8zPtxA

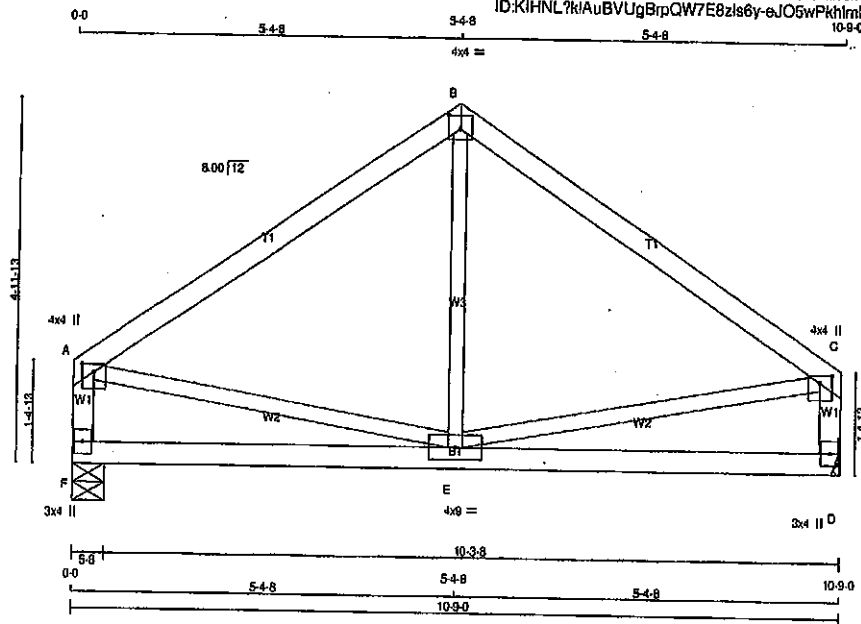

Scale = 1:29.0

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
F - A	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	X
A	TMVW+p	MT20	4.0	4.0	1.25 2.00
B	TTW+p	MT20	4.0	4.0	2.25 2.00
C	TMVW+p	MT20	4.0	4.0	1.25 2.00
D	BMV1+p	MT20	3.0	4.0	
E	BMVWW-I	MT20	4.0	9.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
F	593	0	593	0
D	593	0	593	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
F	419	275 / 0	0 / 0	0 / 0	144 / 0	0 / 0
D	419	275 / 0	0 / 0	0 / 0	144 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	-426 / 0	-91.8 -91.8	0.34 (1)	E-B	-20 / 85	0.03 (4)	
B-C	-426 / 0	-91.8 -91.8	0.34 (1)	A-E	0 / 362	0.08 (1)	
F-A	-554 / 0	0.0 0.0	0.08 (1)	E-C	0 / 362	0.08 (1)	
D-C	-554 / 0	0.0 0.0	0.08 (1)				
F-E	0 / 0	-18.5 -18.5	0.15 (4)				
E-D	0 / 0	-18.5 -18.5	0.15 (4)				

TOTAL WEIGHT = 2 X 41 = 82 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.36")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.01")
ALLOWABLE DEFL. (TL) = $L/360$ (0.36")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.02")

CSI: TC=0.34/1.00 (B-C:1), BC=0.15/1.00 (D-E:4), WB=0.08/1.00 (C-E:1), SS=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1887 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.45 (C) (INPUT = 0.90)
JSI METAL = 0.13 (C) (INPUT = 1.00)

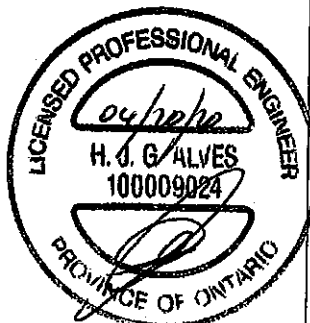


Structural component only
DWG# T-2006474

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408163	T7S	2	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Fri Apr 17 06:48:44 2020 Page 1
ID:KIHNL?kIAuBVUgBrpQW7E8zls6y-6VyT7kV3iFF?4CKIDeLN8p4zBIErFJ5DKZBzP1X9

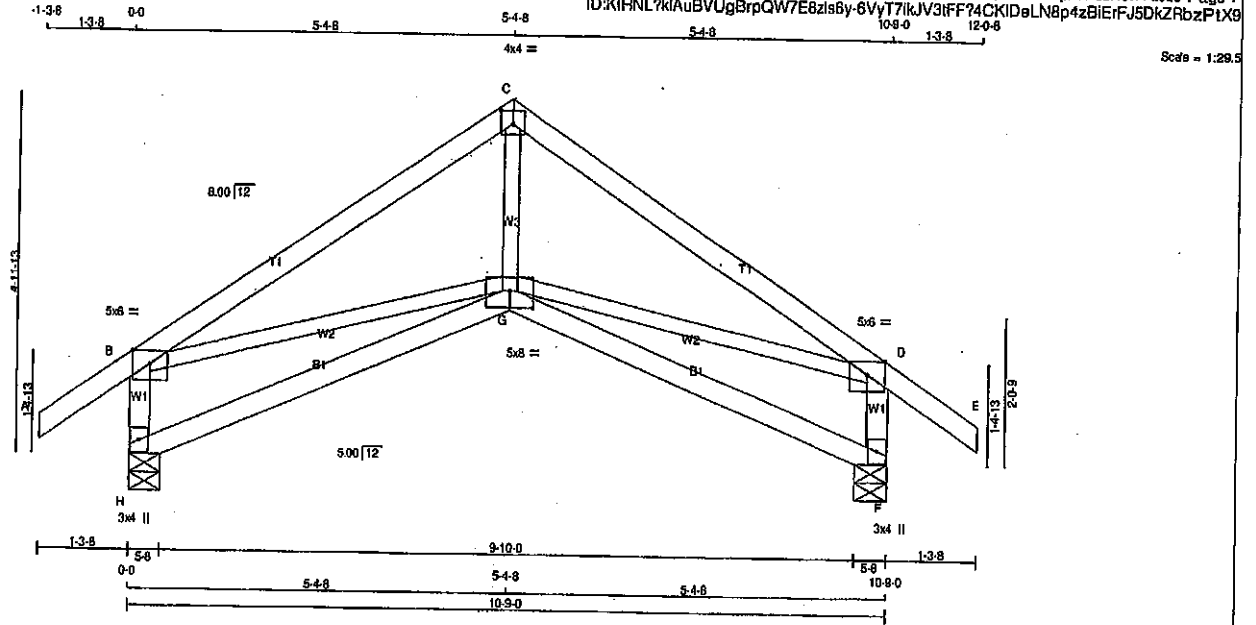

Scale = 1:29.5

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
H - B	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
H - G	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	Edge	
C	TMV-p	MT20	4.0	4.0	2.25	2.00
D	TMVW-p	MT20	5.0	6.0	Edge	
F	BMV1-p	MT20	3.0	4.0		
G	BMVW-p	MT20	5.0	8.0	2.75	4.00
H	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UPLIFT
H	719	0	719	0
F	719	0	719	0

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN, COMPONENT REACTIONS	WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM LIVE	
H	506	345 / 0	0 / 0	0 / 0	161 / 0
F	506	345 / 0	0 / 0	0 / 0	161 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. CSI (LC)	MAX. UNBRACED LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 35	-91.8 -91.8	0.12 (1)	10.00	G-C	0 / 323	0.07 (1)
B-C	-735 / 0	-91.8 -91.8	0.35 (1)	6.25	B-G	0 / 622	0.14 (1)
C-D	-735 / 0	-91.8 -91.8	0.35 (1)	6.25	G-D	0 / 622	0.14 (1)
D-E	0 / 35	-91.8 -91.8	0.12 (1)	10.00			
H-B	-669 / 0	0.0 0.0	0.07 (1)	7.81			
F-D	-669 / 0	0.0 0.0	0.07 (1)	7.81			
H-G	0 / 0	-18.5 -18.5	0.18 (4)	10.00			
G-F	0 / 0	-18.5 -18.5	0.18 (4)	10.00			

TOTAL WEIGHT = 2 X 45 = 90 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.36")

CALCULATED VERT. DEFL.(LL) = L/999 (0.02")

ALLOWABLE DEFL.(TL) = L/360 (0.36")

CALCULATED VERT. DEFL.(TL) = L/999 (0.08")

CSI: TC=0.35/1.00 (B-C:1), BC=0.16/1.00 (G-H:4)

WB=0.14/1.00 (B-G:1), SG=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1667 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.54 (C) (INPUT = 0.90)

JSI METAL = 0.17 (D) (INPUT = 1.00)

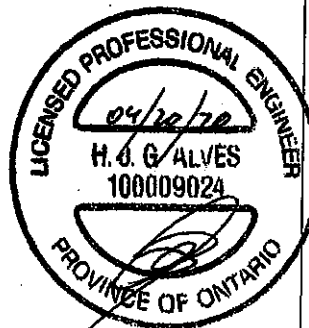


Structural component only
DWG# T-2006475

Scale = 1:19.0



Structural component only 1/2
DWG# T-2006476

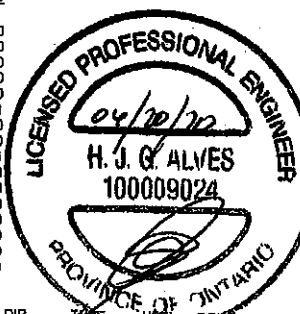

JOB NAME 408163	TRUSS NAME T8	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	


Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Fil Apr 17 14:14:48 2020 Page 2
ID:KIHNL7kAuBYUqBrpQW7E8zls6v-mNKqMOvOu_r/m?dRIMc7KOC9iACD6rdQqx8/hzPoiB

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
Q	10-1-12	-4	-4	---	BACK	VERT	TOTAL	---	C1
R	9-12	-702	-702	---	FRONT	VERT	TOTAL	---	C1
S	2-9-12	-574	-574	---	FRONT	VERT	TOTAL	---	C1
T	6-1-12	-8	-8	---	BACK	VERT	TOTAL	---	C1
U	7-1-12	-1438	-1438	---	FRONT	VERT	TOTAL	---	C1
V	8-1-12	-1	-1	---	BACK	VERT	TOTAL	---	C1
W	10-1-12	-1	-1	---	BACK	VERT	TOTAL	---	C1
X	11-1-12	-1439	-1439	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

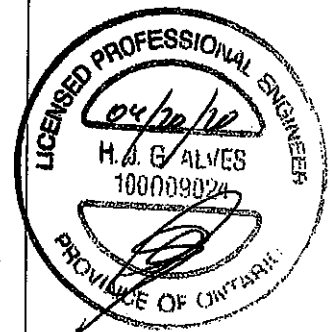


Structural component only
DWG# T-2006476

72

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408165	T21	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 08:44:20 2020 Page 1
 ID:Ovhky48Q0cPQc Y353NoTWzicKo-KoF1vV7 Cqkh_s4XuWdiW0BAKwy8Vdn7 qnOxzPZP
 1-3-8 5-10-8 5-10-8 5-1-2 10-11-10 4-11-14 15-11-8 4-11-14 20-11-8 5-1-2 26-0-8 5-10-8 31-11-0 33-2-8
 Scale = 1:32.0

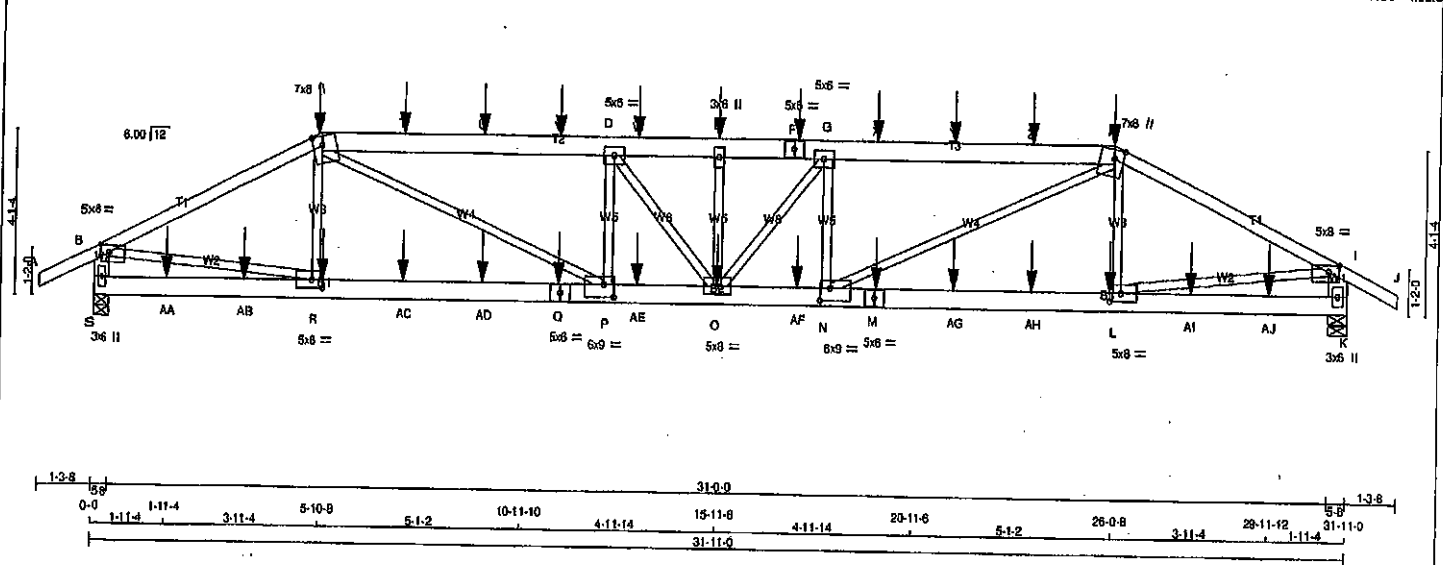

ALL WEBS 2x3 DRY No.2 SPF
 EXCEPT

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.	BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD	SPECIFIED LOADS:
A - C	2x4	DRY	No.2	SPF	SPF	GROSS REACTION	DOWN	GROSS REACTION	BRG	BRG	TOP CH. LL = 25.0 PSF
C - F	2x6	DRY	No.2	SPF	SPF	VERT	3035	DOWN	0	5-8	DL = 8.0 PSF
F - H	2x6	DRY	No.2	SPF	SPF	HORIZ	3034	DOWN	0	5-8	LL = 0.0 PSF
H - J	2x6	DRY	No.2	SPF	SPF	UP	3035	UP	0	5-8	DL = 7.4 PSF
J - L	2x6	DRY	No.2	SPF	SPF	DOWN	3034	DOWN	0	5-8	TOTAL LOAD = 39.0 PSF
L - M	2x6	DRY	No.2	SPF	SPF	UP	3035	UP	0	5-8	
M - K	2x6	DRY	No.2	SPF	SPF	DOWN	3034	DOWN	0	5-8	

ALL WEBS 2x3 DRY No.2 SPF
 EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS SURFACE SPACING (IN) LOAD(PLF)

TOP CHORDS: (0.122"x3") SPIRAL NAILS

A-C 1 12 SIDE(81.0)

H-J 1 12 SIDE(61.0)

C-F 2 12 SIDE(183.1)

F-H 2 12 SIDE(61.0)

S-B 2 12 TOP

K-I 2 12 TOP

BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS

S-Q 2 12 SIDE(183.1)

Q-M 2 12 SIDE(183.1)

M-K 2 12 SIDE(183.1)

WEBS: (0.122"x3") SPIRAL NAILS

2x3 1 8

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLYS FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING.

REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (tablets in inches)

JT TYPE PLATES W LEN Y X

8 TMWV-p MT20 5.0 8.0 2.00 3.25

C TTWV-m MT20 7.0 8.0 2.75 2.75

FACTORED

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
----	------	-----	------	------	------	------	------	------	-------

C	5-10-8	-457	-457	---	FRONT	VERT	TOTAL	---	C1
---	--------	------	------	-----	-------	------	-------	-----	----

E	15-11-8	-110	-110	---	FRONT	VERT	TOTAL	---	C1
---	---------	------	------	-----	-------	------	-------	-----	----

F	17-11-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
---	----------	------	------	-----	-------	------	-------	-----	----


FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
----	------	-----	------	------	------	------	------	------	-------

C	5-10-8	-457	-457	---	FRONT	VERT	TOTAL	---	C1
---	--------	------	------	-----	-------	------	-------	-----	----

E	15-11-8	-110	-110	---	FRONT	VERT	TOTAL	---	C1
---	---------	------	------	-----	-------	------	-------	-----	----

F	17-11-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
---	----------	------	------	-----	-------	------	-------	-----	----

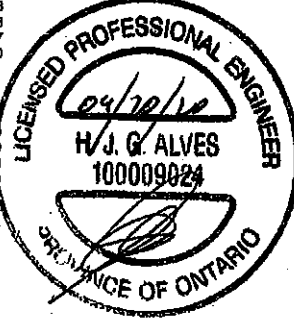

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.0 PSF

DL = 8.0 PSF

LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2010

- PART 9 OF CBC 2012 (2010 AMENDMENT)

- CSA 088-09, CSA 088-14

- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.08")

CALCULATED VERT. DEFL.(LL) = L/999 (0.16")

ALLOWABLE DEFL.(TL) = L/360 (1.08")

CALCULATED VERT. DEFL.(TL) = L/999 (0.30")

CSI: TC=0.48/1.00 (B-C-1), BC=0.47/1.00 (O-P-1), WB=0.51/1.00 (B-R-1), SS=0.20/1.00 (G-H-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.54 (R) (INPUT = 0.90)

JSI METAL = 0.40 (M) (INPUT = 1.00)

Structural component only 1/2

DWG# T-2006487

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408165	T21	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	


Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:44:20 2020 Page 2
ID:Ovnlky48Q0cPQc Y353NoTWzckK0-KoFtVv7 Qqkh s4XuVdIW0BAKwy8Vdn7 qrxOxzP1ZP

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
H	26-0-8	-457	-457	---	FRONT	VERT	TOTAL	---	C1
L	25-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
M	18-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
O	15-11-8	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Q	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	19-11-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	21-11-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	23-11-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	1-11-4	-25	-26	---	FRONT	VERT	TOTAL	---	C1
AB	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AC	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AD	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AE	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AF	17-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	21-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	23-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	27-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	29-11-12	-25	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


- 1) C1: A SUITABLE HANGERMECHANICAL CONNECTION IS REQUIRED.

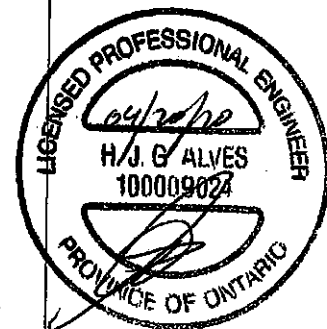

Structural component only
DWG# T-2006487

72

JOB NAME 408165	TRUSS NAME T21Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 26 2019 Mitek Industries, Inc. Fd Apr 17 08:44:21 2020 Page 1		
1-3-8 0-0 5-10-8 5-10-8 7-11-4 9-11-4 10-11-10 10-8 4-11-14 15-11-8 4-11-14 20-11-8 5-1-2 26-0-8 5-10-8 31-11-0 1-3-8 Scale = 1:52.6				ID:Ovhty48Q0cPQc_Y353N0TWzlcKo-o7pP6r0cB7sYb0(RD862D)HvKByE7sGDUbVwOzPIZO 31-11-0 33-2-8		

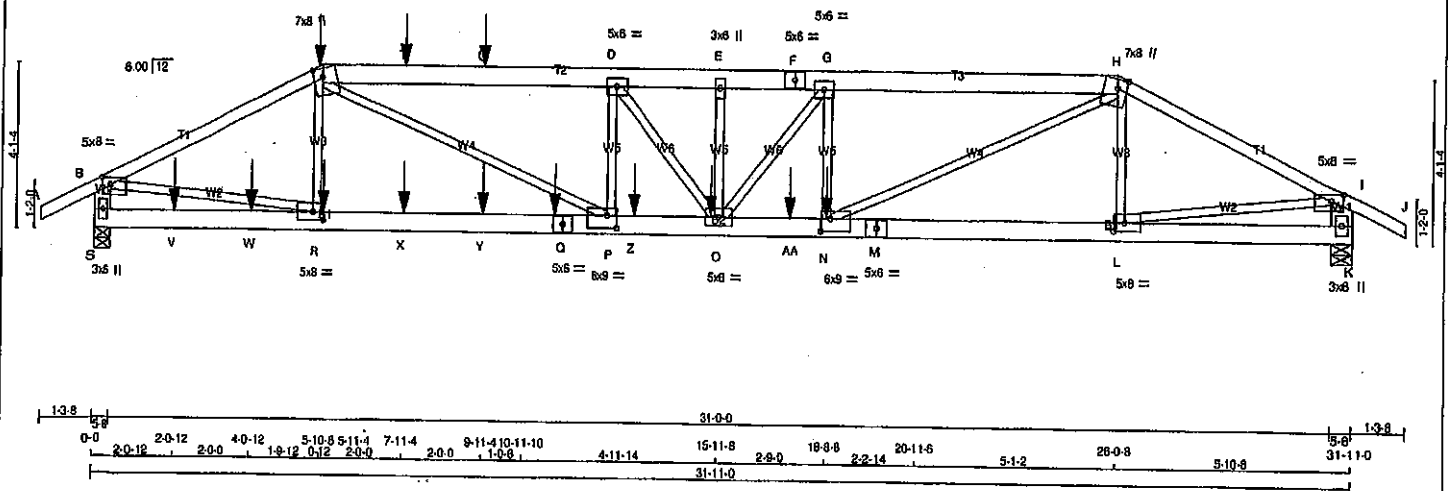

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	DESCR.
A - C	2x4	DRY	No.2
C - F	2x6	DRY	No.2
F - H	2x6	DRY	No.2
H - J	2x4	DRY	No.2
S - B	2x6	DRY	No.2
K - I	2x6	DRY	No.2
S - Q	2x6	DRY	No.2
Q - M	2x6	DRY	No.2
M - K	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C	12	SIDE(81.0)
H-J	12	TOP
C-F	12	SIDE(81.0)
F-H	12	TOP
S-B	12	TOP
K-I	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
S-Q	12	SIDE(183.1)
Q-M	12	SIDE(183.1)
M-K	12	TOP
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	6	SIDE(300.5)
G-N	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (tablets in inches)	W	LEN	Y	X
JT TYPE				
B TMVW-p	MT20	5.0	8.0	2.00 3.25
C ITTWV+m	MT20	7.0	8.0	2.75 2.75
D TMVW-i	MT20	5.0	8.0	
E TMVW-w	MT20	3.0	6.0	
F TS-i	MT20	5.0	6.0	
G TMVW-i	MT20	5.0	6.0	
H ITTWV+m	MT20	7.0	8.0	2.75 2.75
I TMVW-p	MT20	5.0	8.0	2.00 3.25
K BMVW-i	MT20	3.0	6.0	
L BMVW-i	MT20	5.0	8.0	2.50 3.25
M BS-i	MT20	6.0	6.0	
N BMVW-i	MT20	6.0	9.0	3.75 3.00
O BMVW-i	MT20	5.0	8.0	
P BMVW-i	MT20	6.0	9.0	3.75 3.00
Q BS-i	MT20	5.0	6.0	
R BMVW-i	MT20	5.0	8.0	2.50 3.25
S BMVW-i	MT20	3.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
	FACTORED	MAXIMUM FACTORED	INPUT
	GROSS REACTION	GROSS REACTION	BRG
	VERT	DOWN	UPLIFT
	IN-SX	IN-SX	IN-SX
JT	4661	4661	0
S	4115	0	5-8
K	4115	0	5-8

UNFACTORED REACTIONS

1ST CASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW
S	3289	2197 / 0
K	2901	1654 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.09 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED	FACTORED	WEBS
	FORCE	VERT. LOAD	MAX. FACTORED
	(LBS)	(PLF)	FORCE
		CS1 (LC)	MAX. CS1 (LC)
FR-TO			
A-B	0 / 28	-91.8 -91.8 0.07 (1)	10.00
B-C	-7526 / 0	-91.8 -91.8 0.75 (1)	3.09
C-T	-11598 / 0	-91.8 -91.8 0.51 (1)	3.27
T-U	-11598 / 0	-91.8 -91.8 0.51 (1)	3.27
U-D	-11598 / 0	-91.8 -91.8 0.51 (1)	3.27
D-E	-11593 / 0	-91.8 -91.8 0.31 (1)	3.38
E-F	-11893 / 0	-91.8 -91.8 0.29 (1)	3.39
F-G	-11893 / 0	-91.8 -91.8 0.29 (1)	3.39
G-H	-11804 / 0	-91.8 -91.8 0.50 (1)	3.25
H-I	-6538 / 0	-91.8 -91.8 0.65 (1)	3.37
I-J	0 / 28	-91.8 -91.8 0.07 (1)	10.00
S-B	-4635 / 0	0.0 0.0 0.16 (1)	6.71
K-I	-4078 / 0	0.0 0.0 0.14 (1)	7.05

S-V	0 / 0	-18.5 -18.5 0.15 (1)	10.00
V-W	0 / 0	-18.5 -18.5 0.15 (1)	10.00
W-R	0 / 0	-18.5 -18.5 0.15 (1)	10.00
R-X	0 / 8747	-18.5 -18.5 0.69 (1)	10.00
X-Y	0 / 8747	-18.5 -18.5 0.69 (1)	10.00
Y-O	0 / 8747	-18.5 -18.5 0.69 (1)	10.00
O-P	0 / 8747	-18.5 -18.5 0.69 (1)	10.00
P-Z	0 / 11598	-18.5 -18.5 0.94 (1)	10.00
Z-O	0 / 11598	-18.5 -18.5 0.94 (1)	10.00
O-AA	0 / 11803	-18.5 -18.5 0.94 (1)	10.00
AA-N	0 / 11803	-18.5 -18.5 0.94 (1)	10.00
N-M	0 / 5878	-18.5 -18.5 0.48 (1)	10.00
M-L	0 / 5878	-18.5 -18.5 0.48 (1)	10.00
L-K	0 / 0	-18.5 -18.5 0.05 (4)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX	FACE	DIR.
C	5-10-8	-380	-380	---	BACK
N	18-8-8	-1854	-1854	---	BACK
O	15-9-4	-459	-459	---	BACK
Q	11-9-4	-459	-459	---	BACK
R	5-11-4	-258	-258	---	BACK
T	7-11-4	-33	-33	---	BACK
U	9-11-4	-33	-33	---	BACK
V	2-0-12	-41	-41	---	BACK
W	4-0-12	-61	-61	---	BACK
X	7-11-4	-258	-258	---	BACK
Y	9-11-4	-258	-258	---	BACK
Z	13-9-4	-459	-459	---	BACK

TOTAL WEIGHT = 2 X 155 = 311 LB

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.06")

CALCULATED VERT. DEFL. (LL) = L/999 (0.29")

ALLOWABLE DEFL. (TL) = L/360 (1.06")

CALCULATED VERT. DEFL. (TL) = L/717 (0.53")

CS1: TC=0.75/1.00 (B-C:1), BC=0.94/1.00 (N-O:1)

WB=0.84/1.00 (B-R:1), SSI=0.23/1.00 (P-R:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	818	354	1867

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (N) (INPUT = 0.90)

JSI METAL= 0.73 (M) (INPUT = 1.00)

Structural component only 1/2
DWG# T-2006488


CONTINUED ON PAGE 2

JOB NAME 408165	TRUSS NAME T21Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 5 Oct 29 2019 Mitak Industries, Inc. Fri Apr 17 08:44:21 2020 Page 2 ID: Qvhtky48Q0cPQc Y353NoTWzlcKo-a7nPe0cB7sYb0fRD862DiHyKBvE?sgDUbVwOzPiZO		

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LO1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
AA	17-8-4	-459	-459	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

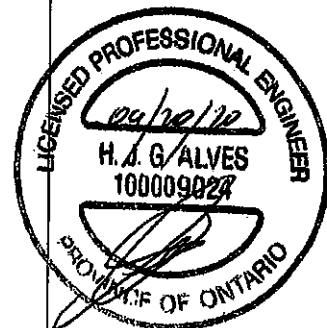


Structural component only
DWG# T-2006488

2/2

JOB NAME 408165	TRUSS NAME T22	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 M/Tek Industries, Inc. Fri Apr 17 08:44:21 2020 Page 1
 ID:1ebEM4Ce92xn94Zv7jkFPizmBH3-o7pP6r0cB7sYb0fRD862DjKBKHRE1RGDUbVwOzPlZO
 1-3-8 0-0 4-0-8 4-0-8 3-10-0 7-10-8 5-5-1 13-3-9 5-3-13 18-7-7 24-0-8 3-10-0 27-10-8 4-0-8 31-11-0 33-2-8
 Scale = 1:52.0

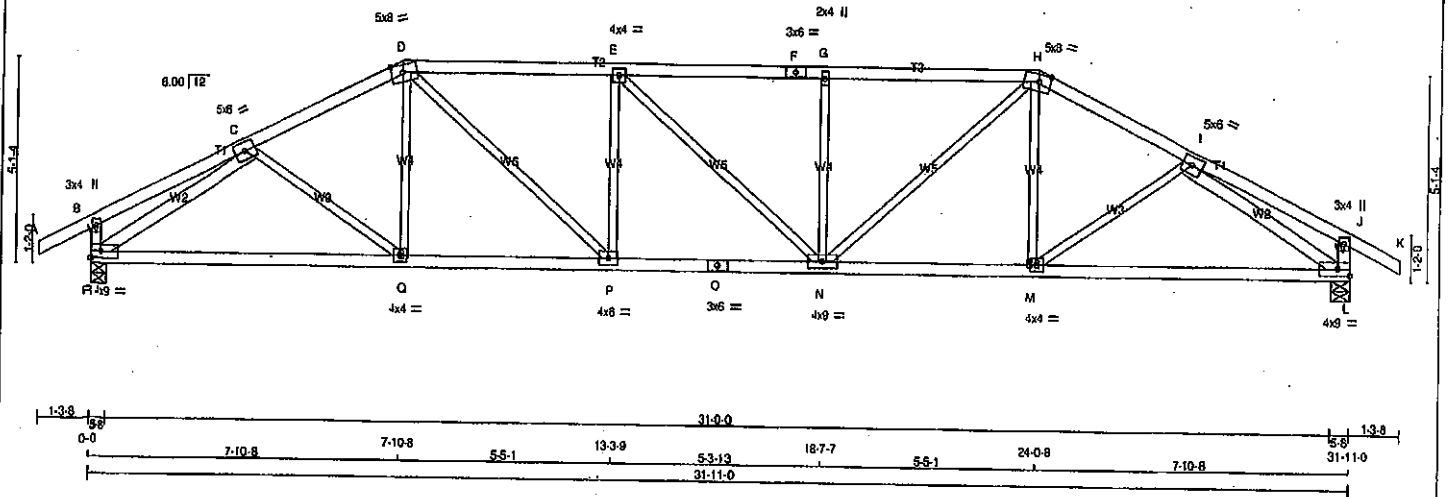

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
R - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
R - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
C	TMWW-1	MT20	5.0	8.0	
D	TTWW-m	MT20	5.0	8.0	2.25 3.50
E	TMWW-1	MT20	4.0	4.0	
F	TS-1	MT20	3.0	6.0	
G	TMW+w	MT20	2.0	4.0	
H	TTWW-m	MT20	5.0	8.0	2.25 3.50
I	TMWW-1	MT20	5.0	8.0	
J	TMV+p	MT20	3.0	4.0	
L	BMVW-1	MT20	4.0	9.0	Edge
M	BMVW-1	MT20	4.0	4.0	
N	BMVW-1	MT20	4.0	9.0	
O	BS-1	MT20	3.0	6.0	
P	BMVW-1	MT20	4.0	6.0	
Q	BMVW-1	MT20	4.0	4.0	
R	BMVW-1	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
R	1884	0	1884	0	5-8
L	1884	0	1884	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
R	1330	888 / 0	0 / 0	0 / 0	444 / 0	0 / 0
L	1330	888 / 0	0 / 0	0 / 0	444 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.61 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED	FORCE	MAX
FR-TO	MEMB.	FORCE (LBS)	VERT. (PLF)	CS1 (LC)	UNBRAC	LENGTH	FR-TO	MEMB.	FORCE (LBS)	CS1 (LC)	
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	C-Q	0 / 74	0.03 (4)			
B-C	0 / 17	-91.8	-91.8	0.20 (1)	10.00	Q-D	0 / 133	0.04 (4)			
C-D	-2469 / 0	-91.8	-91.8	0.30 (1)	4.12	D-P	0 / 933	0.21 (1)			
D-E	-2893 / 0	-91.8	-91.8	0.54 (1)	3.61	P-E	-534 / 0	0.21 (1)			
E-F	-2891 / 0	-91.8	-91.8	0.53 (1)	3.61	E-N	-2 / 0	0.00 (1)			
F-G	-2891 / 0	-91.8	-91.8	0.53 (1)	3.61	N-G	-533 / 0	0.21 (1)			
G-H	-2891 / 0	-91.8	-91.8	0.53 (1)	3.61	H-N	0 / 831	0.21 (1)			
H-I	-2469 / 0	-91.8	-91.8	0.30 (1)	4.12	M-H	0 / 134	0.04 (4)			
I-J	0 / 17	-91.8	-91.8	0.20 (1)	10.00	M-I	0 / 74	0.03 (4)			
J-K	0 / 28	-91.8	-91.8	0.12 (1)	10.00	R-C	-2888 / 0	0.74 (1)			
R-B	-269 / 0	0.0	0.0	0.03 (1)	7.81	I-L	-2887 / 0	0.74 (1)			
L-J	-269 / 0	0.0	0.0	0.03 (1)	7.81						
R-Q	0 / 2167	-18.5	-18.5	0.49 (1)	10.00						
Q-P	0 / 2194	-18.5	-18.5	0.48 (1)	10.00						
P-O	0 / 2893	-18.5	-18.5	0.53 (1)	10.00						
O-N	0 / 2893	-18.5	-18.5	0.53 (1)	10.00						
N-M	0 / 2194	-18.5	-18.5	0.49 (1)	10.00						
M-L	0 / 2168	-18.5	-18.5	0.49 (1)	10.00						

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (1.08")
 CALCULATED VERT. DEFL. (LL) = $L/999$ (0.15")
 ALLOWABLE DEFL. (TL) = $L/360$ (1.08")
 CALCULATED VERT. DEFL. (TL) = $L/999$ (0.29")

CS1: TC=0.54/1.00 (D-E:1), BC=0.53/1.00 (N-P:1),
 WB=0.74/1.00 (I-L:1), SS=0.23/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES		PLATE GRIP (DRY)	SHEAR (PL)	SECTION (PL)
		(PS)	(PL)	(PL)
		MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1687	788
			1987	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (O) (INPUT = 0.90)
 JSI METAL= 0.94 (O) (INPUT = 1.00)

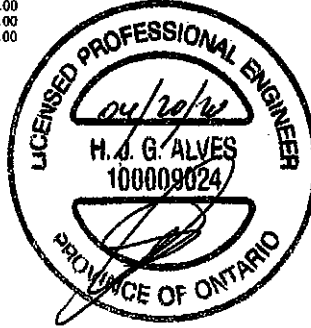

Structural component only
 DWG# T-2006489

JOB NAME 408165	TRUSS NAME T23	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 08:44:22 2020 Page 1	
ID:1abEM4Ce82xn94Zv7kFPizmBR3-GBMoKB1EyR ODAEv?xLbRGV_j8yX8PR8K2SgzPZn				31-11-0 332-8	
1-3-8 0-0 5-0-8 5-0-8 4-10-0 9-10-8 6-1-0 15-11-8 6-1-0 22-0-8 4-10-0 20-10-8 5-0-8 1-3-8				Scale = 1:52.8	

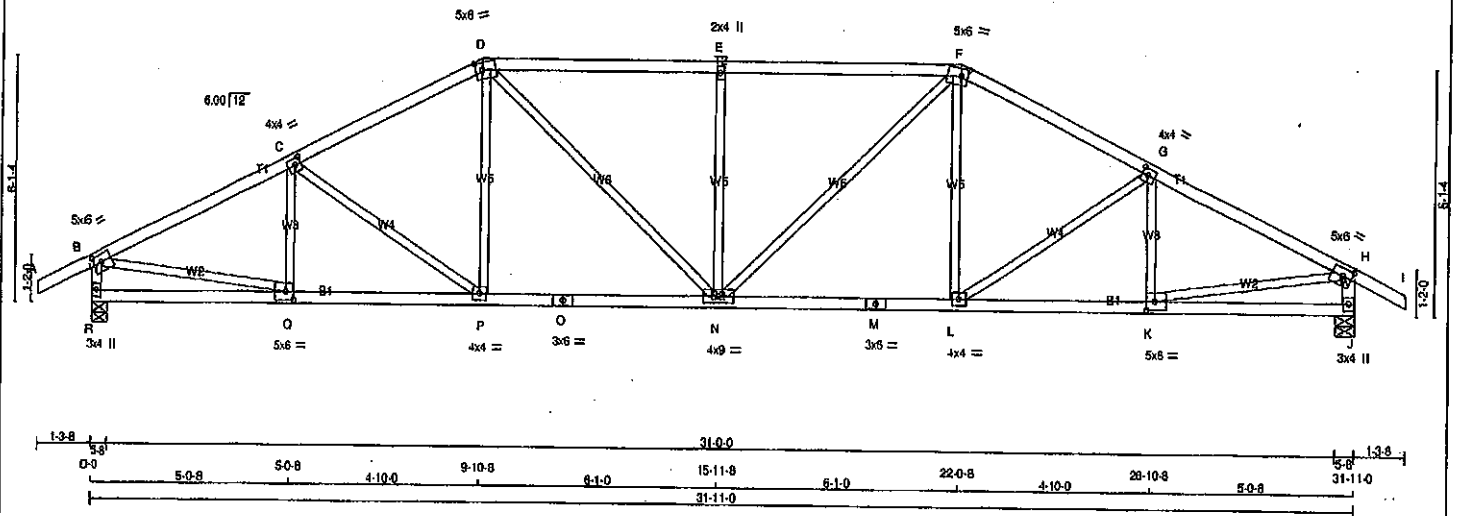

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-1	MT20	5.0	6.0	2.25 2.75
C	TMVW-1	MT20	4.0	4.0	2.00 1.75
D	TTVW-m	MT20	5.0	6.0	2.25 2.00
E	TMVW-w	MT20	2.0	4.0	
F	TTVW-m	MT20	5.0	6.0	2.25 2.00
G	TMVW-1	MT20	4.0	4.0	2.00 1.75
H	TMVW-1	MT20	5.0	6.0	2.25 2.75
J	BMV1-p	MT20	3.0	4.0	
K	BMVW-1	MT20	5.0	6.0	2.50 2.50
L	BMVW-1	MT20	4.0	4.0	
M	BS-1	MT20	3.0	6.0	
N	BMVWW-1	MT20	4.0	9.0	
O	BS-1	MT20	3.0	6.0	
P	BMVW-1	MT20	4.0	4.0	
Q	BMVW-1	MT20	5.0	6.0	2.50 2.50
R	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
		GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORIZ	GROSS REACTION	UPLIFT	IN-SX
R	1884	0	1884	0	5-8
J	1884	0	1884	0	5-8

UNFACTORED REACTIONS

1ST LOUSE		MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	1330	888 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0
J	1330	888 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.82 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO	LENGTH FR-TO
A-B	0 / 28	-91.8 -91.8 0.12 (1)	10.00
B-C	-2538 / 0	-91.8 -91.8 0.37 (1)	4.02
C-D	-2342 / 0	-91.8 -91.8 0.35 (1)	4.17
D-E	-2493 / 0	-91.8 -91.8 0.54 (1)	3.82
E-F	-2493 / 0	-91.8 -91.8 0.54 (1)	3.82
F-G	-2342 / 0	-91.8 -91.8 0.35 (1)	4.17
G-H	-2538 / 0	-91.8 -91.8 0.37 (1)	4.02
H-I	0 / 28	-91.8 -91.8 0.12 (1)	10.00
R-B	-1841 / 0	0.0 0.0 0.19 (1)	6.17
J-H	-1841 / 0	0.0 0.0 0.19 (1)	6.17
R-Q	0 / 0	-18.5 -18.5 0.10 (4)	10.00
Q-P	0 / 2290	-18.5 -18.5 0.43 (1)	10.00
P-O	0 / 2077	-18.5 -18.5 0.40 (1)	10.00
O-N	0 / 2077	-18.5 -18.5 0.40 (1)	10.00
N-M	0 / 2077	-18.5 -18.5 0.40 (1)	10.00
M-L	0 / 2077	-18.5 -18.5 0.40 (1)	10.00
L-K	0 / 2290	-18.5 -18.5 0.43 (1)	10.00
K-J	0 / 0	-18.5 -18.5 0.10 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(66 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.06")
CALCULATED VERT. DEFL.(LL) = L/999 (0.13")
ALLOWABLE DEFL.(TL) = L/360 (1.06")
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.54/1.00 (D-E:1), BC=0.43/1.00 (K-L:1),
WB=0.52/1.00 (H-K:1), SS=0.27/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1937 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (B) (INPUT = 0.90)
JSI METAL= 0.87 (B) (INPUT = 1.00)

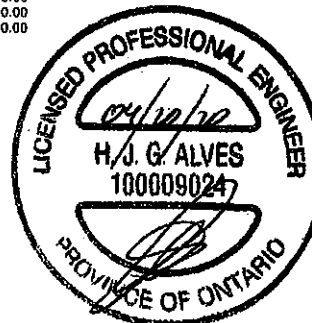


Structural component only
DWG# T-2006490

Scale = 1:52.6



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408165	T25	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2018 MITek Industries, Inc. Fri Apr 17 08:44:22 2020 Page 1
 ID:1ebEM4Ce92xn94Zv7jkFPizmBR3-CBMokB1Eyr_ODAEv7xILbRGRCjPyXzPR8K2SqzPIZN
 31-11-0 33-2-8
 Scale = 1:63.3

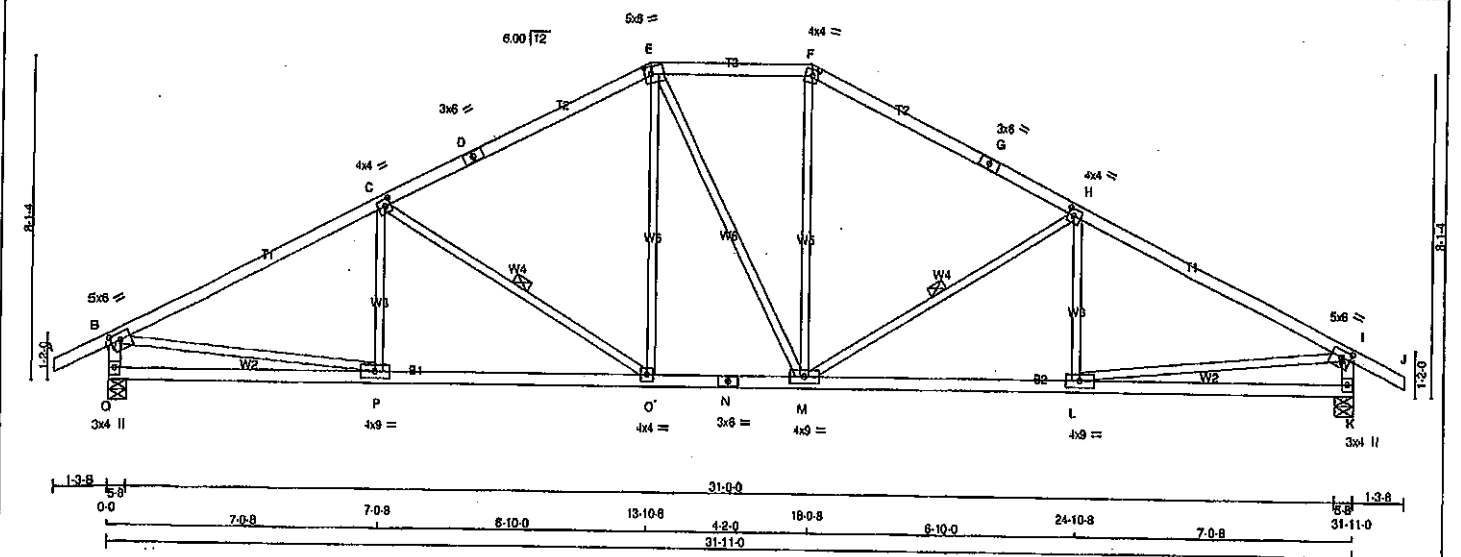

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
E - F	2x4	DRY	No.2	SPF	
F - G	2x4	DRY	No.2	SPF	
G - J	2x4	DRY	No.2	SPF	
J - K	2x4	DRY	No.2	SPF	
K - L	2x4	DRY	No.2	SPF	
L - N	2x4	DRY	No.2	SPF	
N - K	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2
 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	5.0	8.0	2.00	2.75
C	TMVW-1	MT20	4.0	4.0	2.00	1.75
D	TS-1	MT20	3.0	8.0		
E	TTWW-m	MT20	5.0	8.0	2.25	2.00
F	TTW-m	MT20	4.0	4.0	2.00	1.75
G	TS-1	MT20	3.0	8.0		
H	TMVW-1	MT20	4.0	4.0	2.00	1.75
I	TMVW-1	MT20	5.0	8.0	2.00	2.75
K	BMV1+p	MT20	3.0	4.0		
L	BMVW-1	MT20	4.0	9.0		
M	BMVW-1	MT20	4.0	9.0		
N	BS-1	MT20	3.0	8.0		
O	BMVW-1	MT20	4.0	4.0		
P	BMVW-1	MT20	4.0	9.0		
Q	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
Q	1884	0	1884	0
K	1884	0	1884	0

UNFACTORED REACTIONS	1ST CASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
Q	1330	866 / 0	0 / 0
K	1330	866 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, K

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-O, H-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
 TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)
FR-TO					FR-TO		
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	P-C	-140 / 71
B-C	-2587 / 0	-91.8	-91.8	0.78 (1)	3.47	C-O	-881 / 0
C-D	-2013 / 0	-91.8	-91.8	0.68 (1)	3.97	O-E	0 / 458
D-E	-2013 / 0	-91.8	-91.8	0.68 (1)	3.97	E-M	0 / 2
E-F	-1775 / 0	-91.8	-91.8	0.24 (1)	4.79	M-F	-680 / 0
F-G	-2013 / 0	-91.8	-91.8	0.68 (1)	3.97	M-H	-142 / 70
G-H	-2013 / 0	-91.8	-91.8	0.68 (1)	3.97	H-I	0 / 2362
H-I	-2587 / 0	-91.8	-91.8	0.78 (1)	3.47	B-P	0 / 2361
I-J	0 / 28	-91.8	-91.8	0.12 (1)	10.00	L-I	0.53 (1)
Q-B	-1830 / 0	0.0	0.0	0.18 (1)	6.19		
K-I	-1830 / 0	0.0	0.0	0.18 (1)	6.19		
Q-P	0.0	-18.5	-18.5	0.22 (4)	10.00		
P-O	0 / 2344	-18.5	-18.5	0.48 (1)	10.00		
O-N	0 / 1774	-18.5	-18.5	0.35 (1)	10.00		
N-M	0 / 1774	-18.5	-18.5	0.35 (1)	10.00		
M-L	0 / 2344	-18.5	-18.5	0.48 (1)	10.00		
L-K	0 / 0	-18.5	-18.5	0.22 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF NBCC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.06")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
 ALLOWABLE DEFL.(TL) = L/360 (1.06")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.78/1.00 (B-C:1), BC=0.48/1.00 (O-P:1), WB=0.53/1.00 (B-P:1), SS=0.28/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 518 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

GRIP= 0.83 (B) (INPUT = 0.80)
 METAL= 0.70 (B) (INPUT = 1.00)

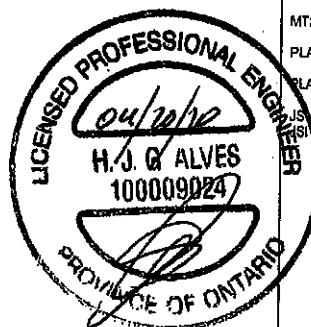


Structural component only
 DWG# T-2006492

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408165	T26	8	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Fri Apr 17 09:44:23 2020 Page 1
ID:1abEM4Ce92x94Zv7[kFPizmBR3-kNwAXX1Uj6Fk06ZaBa7eo]N7_Bh_xZqn4b_GzPizM

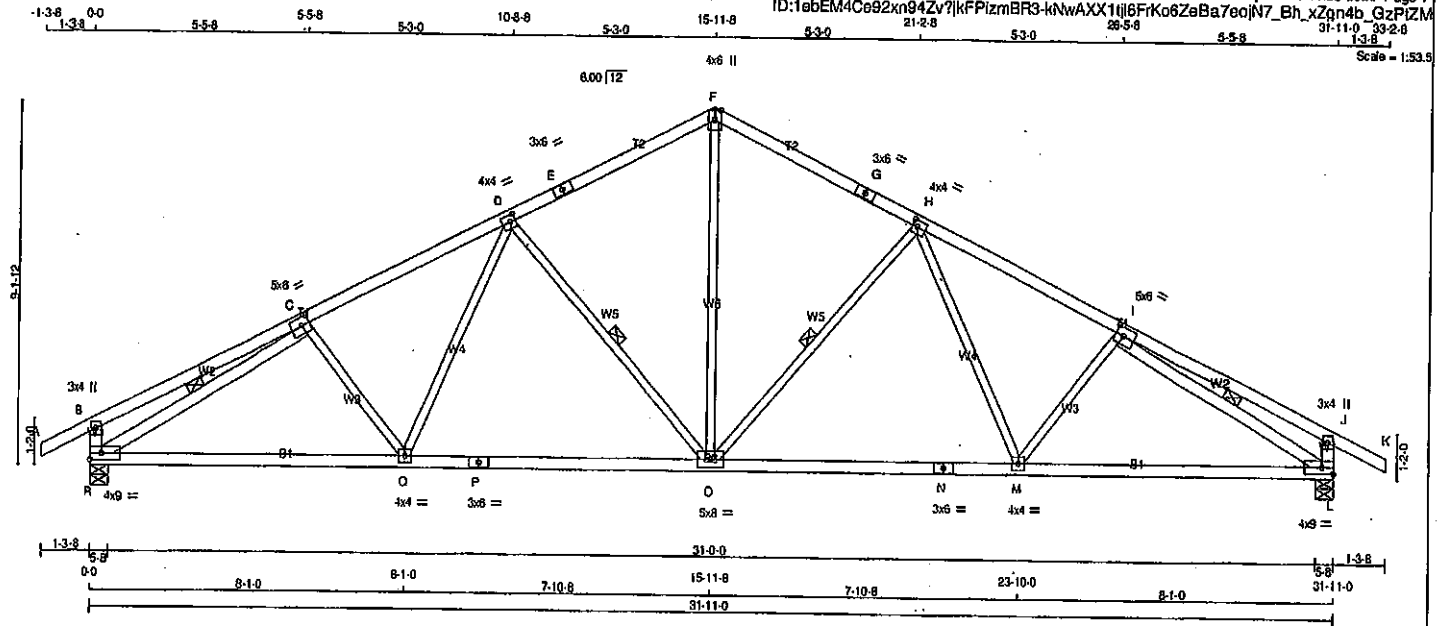

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - K	2x4	DRY	No.2
R - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
R - P	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
R - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
C	TMWW+1	MT20	5.0	8.0	2.50 2.50
D	TMWW+1	MT20	4.0	4.0	2.00 1.50
E	TS-1	MT20	3.0	8.0	
F	TTW+p	MT20	4.0	8.0	Edge
G	TS-1	MT20	3.0	8.0	
H	TMWW+1	MT20	4.0	4.0	2.00 1.50
I	TMWW+1	MT20	5.0	8.0	2.50 2.50
J	TMV+p	MT20	3.0	4.0	
L	BMVW+1	MT20	4.0	9.0	Edge
M	BMVW+1	MT20	4.0	4.0	
N	BS-1	MT20	3.0	6.0	
O	BMVW+1	MT20	5.0	8.0	
P	BS-1	MT20	3.0	6.0	
Q	BMVW+1	MT20	4.0	4.0	
R	BMVW+1	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	IN-SX
R	1884	0	0	1884	0	0	0	5-8	5-8
L	1884	0	0	1884	0	0	0	5-8	5-8

UNFACTORED REACTIONS		1ST LCASE		MAX./MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
R	1330	886 / 0	0 / 0	0 / 0	0 / 0
L	1330	886 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.11 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF H-O, O-C, C-R, H-L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING		TOTAL LCASES: (4)	
CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH FR-TO
A-B	0 / 28	-91.8	-91.8 0.12 (1)
B-C	0 / 20	-91.8	-91.8 0.33 (1)
C-D	-2428 / 0	-91.8	-91.8 0.37 (1)
D-E	-1808 / 0	-91.8	-91.8 0.34 (1)
E-F	-1808 / 0	-91.8	-91.8 0.34 (1)
F-G	-1808 / 0	-91.8	-91.8 0.34 (1)
G-H	-1808 / 0	-91.8	-91.8 0.34 (1)
H-I	-2428 / 0	-91.8	-91.8 0.37 (1)
I-J	0 / 20	-91.8	-91.8 0.33 (1)
J-K	0 / 28	-91.8	-91.8 0.12 (1)
R-B	-325 / 0	0.0	0.0 0.03 (1)
L-J	-325 / 0	0.0	0.0 0.03 (1)
R-Q	0 / 2268	-18.5	-18.5 0.51 (1)
Q-P	0 / 2051	-18.5	-18.5 0.48 (1)
P-O	0 / 2051	-18.5	-18.5 0.48 (1)
O-N	0 / 2051	-18.5	-18.5 0.48 (1)
N-M	0 / 2051	-18.5	-18.5 0.48 (1)
M-L	0 / 2268	-18.5	-18.5 0.51 (1)

TOTAL WEIGHT = 8 X 133 = 1068 LB

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BOBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.08")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.08")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.24")

CSI: TC=0.37/1.00 (H-I:1), BC=0.51/1.00 (L-M:1), WB=0.55/1.00 (H-L:1), SS=0.20/1.00 (J-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.85 (1) (INPUT = 0.90)
JSI METAL= 0.87 (1) (INPUT = 1.00)

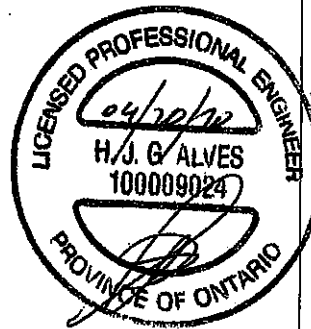

Structural component only
DWG# T-2006493

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408164	T27	2	1	GREEN PARK HOMES	
TAMMACK ROOF TRUSS, BURLINGTON				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:55:33 2020 Page 1
 ID:1ebEM4Ce92xn94Zv7kFPizmBR3-wkKmOI17nE1vSuRxBTBRBPSAJa9BzYmWVhS1cUzMDcO
 1-3-8 0-0 4-8-5 4-8-5 5-8-3 10-4-9 5-8-15 15-11-8 5-8-15 21-6-7 5-8-3 27-2-11 4-8-5 31-11-0 33-2-8
 1-3-8
 Scale = 1:32.0

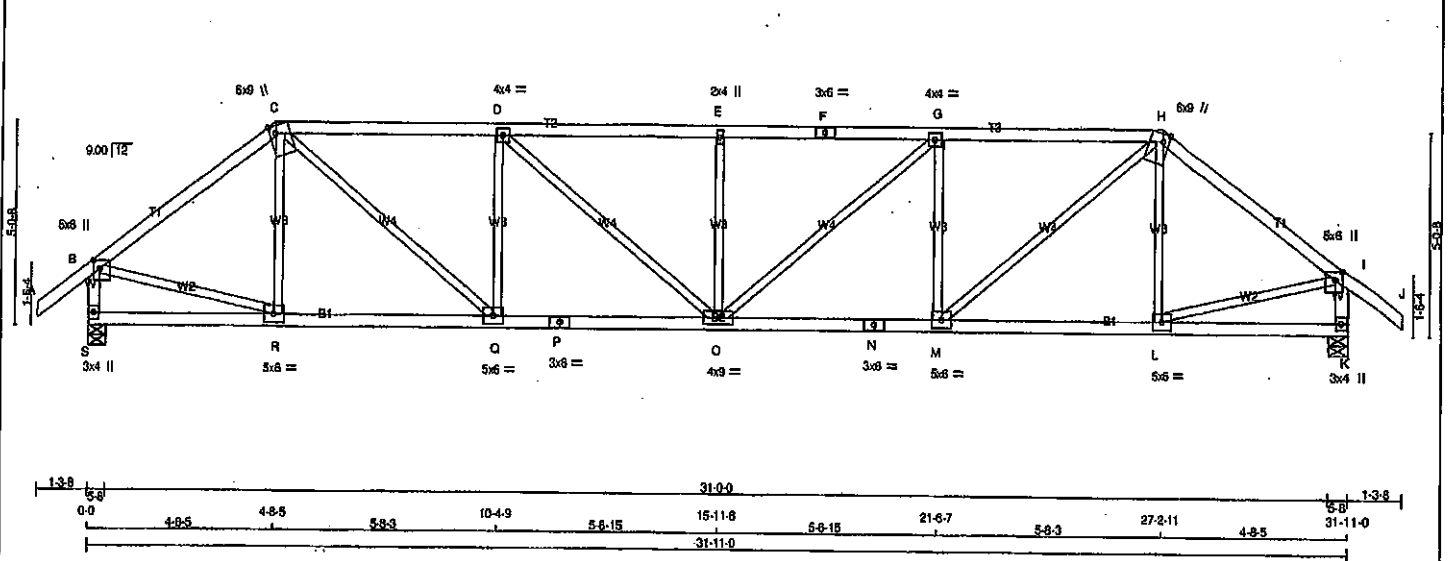

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4 DRY	No.2	SPF
O - F	2x4 DRY	No.2	SPF
F - H	2x4 DRY	No.2	SPF
H - J	2x4 DRY	No.2	SPF
S - B	2x4 DRY	No.2	SPF
K - I	2x4 DRY	No.2	SPF
S - P	2x4 DRY	No.2	SPF
P - N	2x4 DRY	No.2	SPF
N - K	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMWw+p	MT20	5.0	8.0 2.50 2.00
C	TTWW+m	MT20	6.0	9.0 Edge 2.00
D	TMWw+1	MT20	4.0	4.0
E	TMWw+w	MT20	2.0	4.0
F	TS-1	MT20	3.0	6.0
G	TMWw+1	MT20	4.0	4.0
H	TTWW+m	MT20	8.0	9.0 Edge 2.00
I	TMWw+p	MT20	5.0	8.0 2.50 2.00
K	BMV1+p	MT20	3.0	4.0
L, M, Q, R				
L	BMWw+1	MT20	6.0	6.0
N	BS-1	MT20	3.0	6.0
O	BMWwW-1	MT20	4.0	9.0
P	BS-1	MT20	3.0	6.0
S	BMV1+p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
BEARINGS							
	FACTORED	MAXIMUM FACTORED	INPUT	RECORD			
	GROSS REACTION	GROSS REACTION	BRG	BRG			
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	N-SX	IN-SX
S	1888	0	1888	0	0	5-8	5-8
K	1888	0	1888	0	0	5-8	5-8
UNFACTORED REACTIONS							
	1ST CASE	MAX/MIN.	COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1331	887 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0
K	1331	887 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K
 BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.42 FT.
 MAX. UNBRAIDED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING							
TOTAL LOAD CASES: (4)							
CHORDS							
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH
FR-TO					FR-TO		
A-B	0 / 38	-91.8	-91.8 0.12 (1)	10.00	R-C	-266 / 0	0.10 (1)
B-C	-1888 / 0	-91.8	-91.8 0.45 (1)	4.42	C-Q	0 / 1515	0.34 (1)
C-D	-2884 / 0	-91.8	-91.8 0.51 (1)	3.65	Q-D	-888 / 0	0.32 (1)
D-E	-3002 / 0	-91.8	-91.8 0.55 (1)	3.42	D-O	0 / 443	0.10 (1)
E-F	-3002 / 0	-91.8	-91.8 0.55 (1)	3.42	O-E	-472 / 0	0.18 (1)
F-G	-3002 / 0	-91.8	-91.8 0.55 (1)	3.42	C-G	0 / 443	0.10 (1)
G-H	-2884 / 0	-91.8	-91.8 0.51 (1)	3.65	M-G	-888 / 0	0.32 (1)
H-I	-1888 / 0	-91.8	-91.8 0.45 (1)	4.42	M-H	0 / 1515	0.34 (1)
I-J	0 / 38	-91.8	-91.8 0.12 (1)	10.00	L-H	-266 / 0	0.10 (1)
S-B	-1852 / 0	0.0	0.0 0.19 (1)	6.16	B-R	0 / 1552	0.35 (1)
K-I	-1852 / 0	0.0	0.0 0.19 (1)	6.16	L-I	0 / 1552	0.35 (1)
S-R	0 / 0	-18.5	-18.5 0.12 (4)	10.00			
R-Q	0 / 1500	-18.5	-18.5 0.31 (1)	10.00			
Q-P	0 / 2665	-18.5	-18.5 0.48 (1)	10.00			
P-O	0 / 2665	-18.5	-18.5 0.48 (1)	10.00			
O-N	0 / 2665	-18.5	-18.5 0.48 (1)	10.00			
N-M	0 / 2665	-18.5	-18.5 0.48 (1)	10.00			
M-L	0 / 1500	-18.5	-18.5 0.31 (1)	10.00			
L-K	0 / 0	-18.5	-18.5 0.12 (4)	10.00			

TOTAL WEIGHT = 2 X 130 = 261 lb

DESIGN CRITERIA			
SPECIFIED LOADS:			
TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.06")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.15")
 ALLOWABLE DEFL.(TL) = L/360 (1.06")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.28")

CSI: TC=0.85/1.00 (D-E-I), BC=0.48/1.00 (C-Q-I), WB=0.35/1.00 (B-R-I), SSI=0.24/1.00 (C-D-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP(DRY)	SHEAR	SECTION	
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1907 768	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.90 (B) (INPUT = 0.90)
 JSI METAL= 0.81 (P) (INPUT = 1.00)



Structural component only
 DWG# T-2007733

JOB NAME 408164	TRUSS NAME T28	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 26 10:55:34 2020 Page 1
 ID:1ebEM4Cs92xn94Zv7kFPizmBR3-O_u8ce2dYY9m3207kAljd_KR_W9iu5glLb8wzMDcN
 1-3.8 0.0 3-4.1 3-4.1 3-1.9 6-5.11 6-4.5 12-10.0 6-3.1 19-1.0 6-4.5 25-5.5 3-1.9 28-6.15 3-4.1 31-11.0 33-2.8
 Scale = 1:52.8

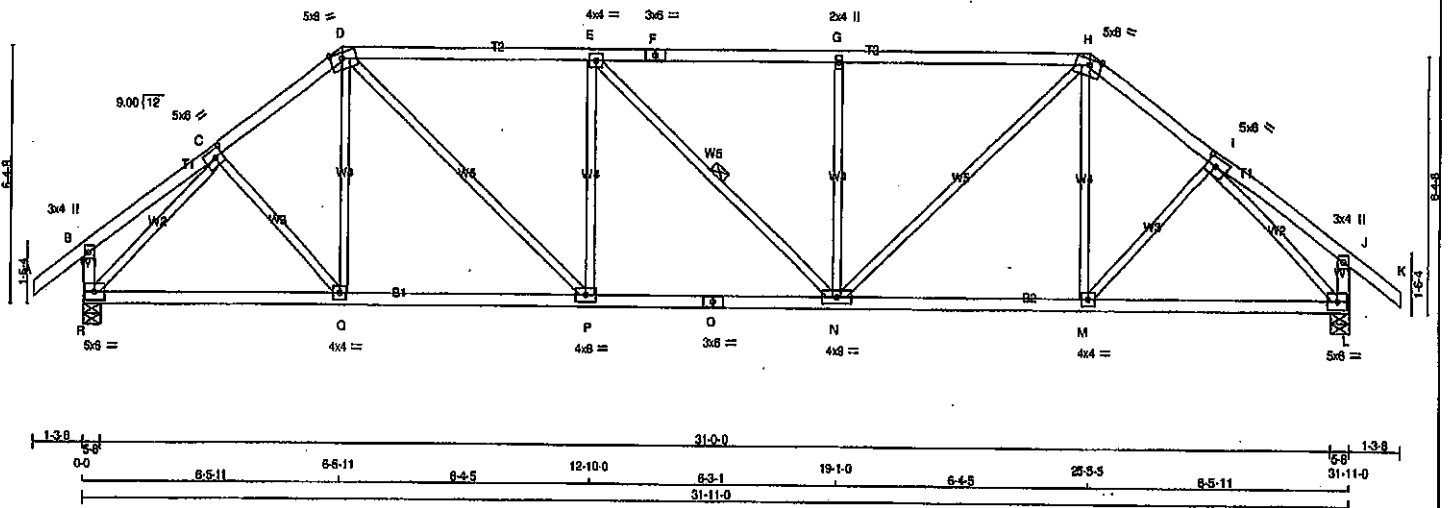

LUMBER			
N L G A RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
R - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+P	MT20	3.0	4.0
C	TMWW+I	MT20	5.0	8.0 2.50 2.75
D	TTWW-m	MT20	5.0	8.0 Edge 3.50
E	TMWW-I	MT20	4.0	4.0
F	TS-I	MT20	3.0	6.0
G	TMW+V	MT20	2.0	4.0
H	TTWW-m	MT20	5.0	8.0 Edge 3.50
I	TMWW-I	MT20	5.0	8.0 2.50 2.75
J	TMV+P	MT20	3.0	4.0
L	BMVW-I	MT20	5.0	6.0
M	BMWW-I	MT20	4.0	4.0
N	BMWW-I	MT20	4.0	9.0
O	BS-I	MT20	3.0	6.0
P	BMWW-I	MT20	4.0	6.0
Q	BMWW-I	MT20	4.0	4.0
R	BMVW-I	MT20	5.0	6.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT
R	1888	0	1888	0	5-8
L	1888	0	1888	0	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	1331	887 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0
L	1331	887 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.78 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO				FR-TO			
A-B	0 / 38	-91.8	-91.8 0.12 (1)	10.00	C-Q	0 / 131	0.03 (4)
B-C	0 / 18	-91.8	-91.8 0.13 (1)	10.00	C-D	0 / 88	0.03 (4)
C-D	-1910 / 0	-91.8	-91.8 0.18 (1)	4.71	D-P	0 / 1071	0.24 (1)
D-E	-2288 / 0	-91.8	-91.8 0.89 (1)	3.78	P-E	-827 / 0	0.41 (1)
E-F	-2284 / 0	-91.8	-91.8 0.88 (1)	3.78	E-N	-2 / 0	0.00 (1)
F-G	-2284 / 0	-91.8	-91.8 0.88 (1)	3.78	N-G	-827 / 0	0.41 (1)
G-H	-2284 / 0	-91.8	-91.8 0.88 (1)	3.80	N-H	0 / 1089	0.24 (1)
H-I	-1910 / 0	-91.8	-91.8 0.18 (1)	4.71	M-H	0 / 88	0.03 (4)
I-J	0 / 18	-91.8	-91.8 0.13 (1)	10.00	M-I	0 / 131	0.03 (4)
J-K	0 / 38	-91.8	-91.8 0.12 (1)	10.00	R-C	-2134 / 0	0.79 (1)
R-B	-245 / 0	0.0	0.0 0.03 (1)	7.81	I-L	-2134 / 0	0.79 (1)
L-J	-245 / 0	0.0	0.0 0.03 (1)	7.81			

R-Q	0 / 1420	-18.5	-18.5 0.33 (1)	10.00
Q-P	0 / 1510	-18.5	-18.5 0.35 (1)	10.00
P-O	0 / 2288	-18.5	-18.5 0.43 (1)	10.00
O-N	0 / 2288	-18.5	-18.5 0.43 (1)	10.00
N-M	0 / 1511	-18.5	-18.5 0.35 (1)	10.00
M-L	0 / 1421	-18.5	-18.5 0.33 (1)	10.00

TOTAL WEIGHT = 2 X 137 = 274 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TBC 2011, TBC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.08")
 CALCULATED VERT. DEFL.(LL) = L/889 (0.10")
 ALLOWABLE DEFL.(TL) = L/360 (1.08")
 CALCULATED VERT. DEFL.(TL) = L/989 (0.21")

CSI: TC=0.69/1.00 (D-E:1), BC=0.43/1.00 (N-P:1), WB=0.79/1.00 (L:1), SS=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 788 1987 1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.87 (L) (INPUT = 0.90)
 JSI METAL= 0.78 (C) (INPUT = 1.00)



Structural component only
 DWG# T-2007734

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408164	T29	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington			TRUSS DESC.		

Version 8.310 S Oct 28 2019 Mitek Industries, Inc. Tue Apr 28 10:55:35 2020 Page 1
 ID:1ebEM4Ce92xn94Zv7kfPzmBR3-1ASWp_2FjrHdhBbJluDvGqXT4OIXRjnp_7x8gNzMDcm
 31-11-0 33-2-8 1-3-8
 Scale = 1:52.6

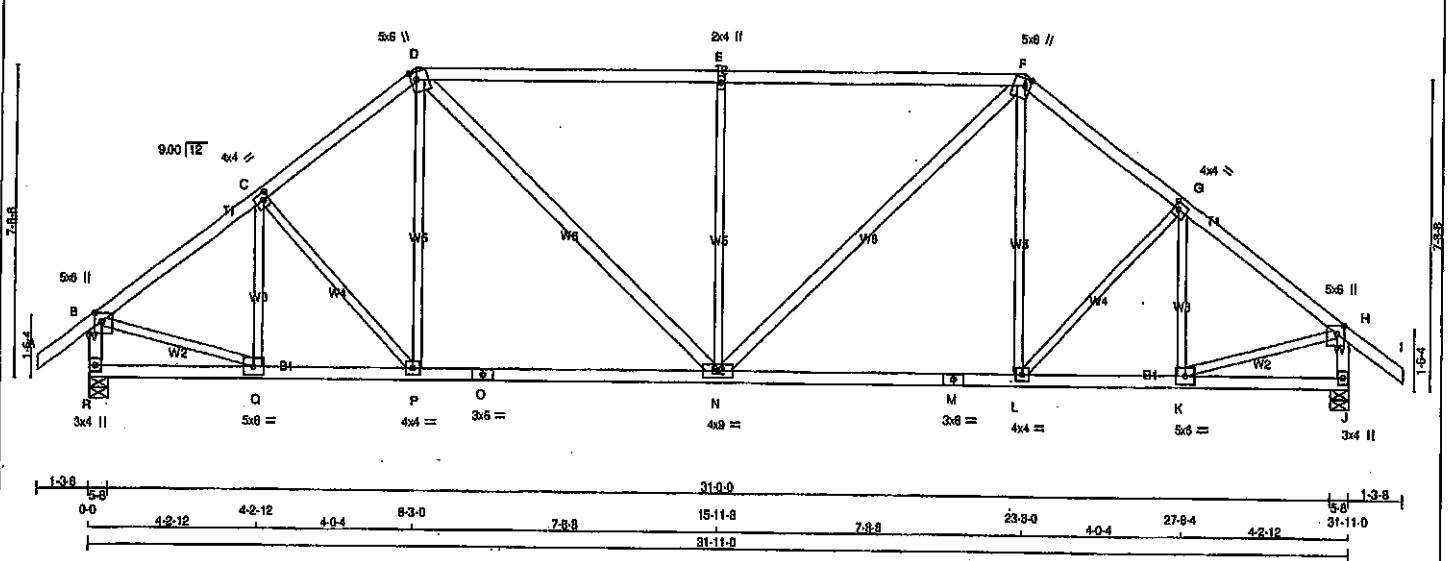

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	8.0	2.50	2.00
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TMVW+m	MT20	5.0	8.0	2.25	1.50
E	TMVW-w	MT20	2.0	4.0		
F	TTVW+m	MT20	5.0	6.0	2.25	1.50
G	TMVW-t	MT20	4.0	4.0	2.00	1.50
H	TMVW+p	MT20	5.0	8.0	2.50	2.00
J	BMV1+p	MT20	3.0	4.0		
K	BMVW-t	MT20	5.0	8.0		
L	BMVW-t	MT20	4.0	4.0		
M	BS-t	MT20	3.0	8.0		
N	BMVW-w	MT20	4.0	9.0		
O	BS-t	MT20	3.0	6.0		
P	BMVW-t	MT20	4.0	4.0		
Q	BMVW-t	MT20	5.0	6.0		
R	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG
R	1888 0	1888 0	5-8
J	1888 0	1888 0	5-8

UNFACTORED REACTIONS			
JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	
R	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL	
J	1331 887/0	0/0 0/0 0/0 444/0 0/0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.61 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO			
A-B	0/38	-91.8	-91.8 0.12 (1)
B-C	-1877/0	-91.8	-91.8 0.24 (1)
C-D	-1858/0	-91.8	-91.8 0.24 (1)
D-E	-1995/0	-91.8	-91.8 0.24 (1)
E-F	-1995/0	-91.8	-91.8 0.24 (1)
F-G	-1858/0	-91.8	-91.8 0.24 (1)
G-H	-1877/0	-91.8	-91.8 0.24 (1)
H-I	0/38	-91.8	-91.8 0.12 (1)
R-B	-1849/0	0.0	0.0 0.19 (1)
J-H	-1849/0	0.0	0.0 0.19 (1)
R-Q	0/0	-18.5	-18.5 0.08 (4)
Q-P	0/1522	-18.5	-18.5 0.33 (1)
P-O	0/1465	-18.5	-18.5 0.33 (1)
O-N	0/1465	-18.5	-18.5 0.33 (1)
N-M	0/1465	-18.5	-18.5 0.33 (1)
M-L	0/1465	-18.5	-18.5 0.33 (1)
L-K	0/1522	-18.5	-18.5 0.33 (1)
K-J	0/0	-18.5	-18.5 0.08 (4)

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF NBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.08")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
 ALLOWABLE DEFL.(TL) = L/360 (1.08")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.17")

CSI: TC=0.82/1.00 (D-E:1), BC=0.36/1.00 (N-P:1), WB=0.98/1.00 (E-N:1), SS=0.34/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1987 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.80 (B) (INPUT = 0.90)
 JSI METAL= 0.46 (C) (INPUT = 1.00)




Structural component only
 DWG# T-2007735

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408164	T30	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:55:38 2020 Page 1
ID:1ebEM4Ce92xn94Zv7jKfPlzmBR3-LM0u1J3149PUJLAVsbk8o24jboEYAvKyDighDpzMDcL
21-10-10 26-9-9 31-11-0 33-8-8
Scale = 1:53.1

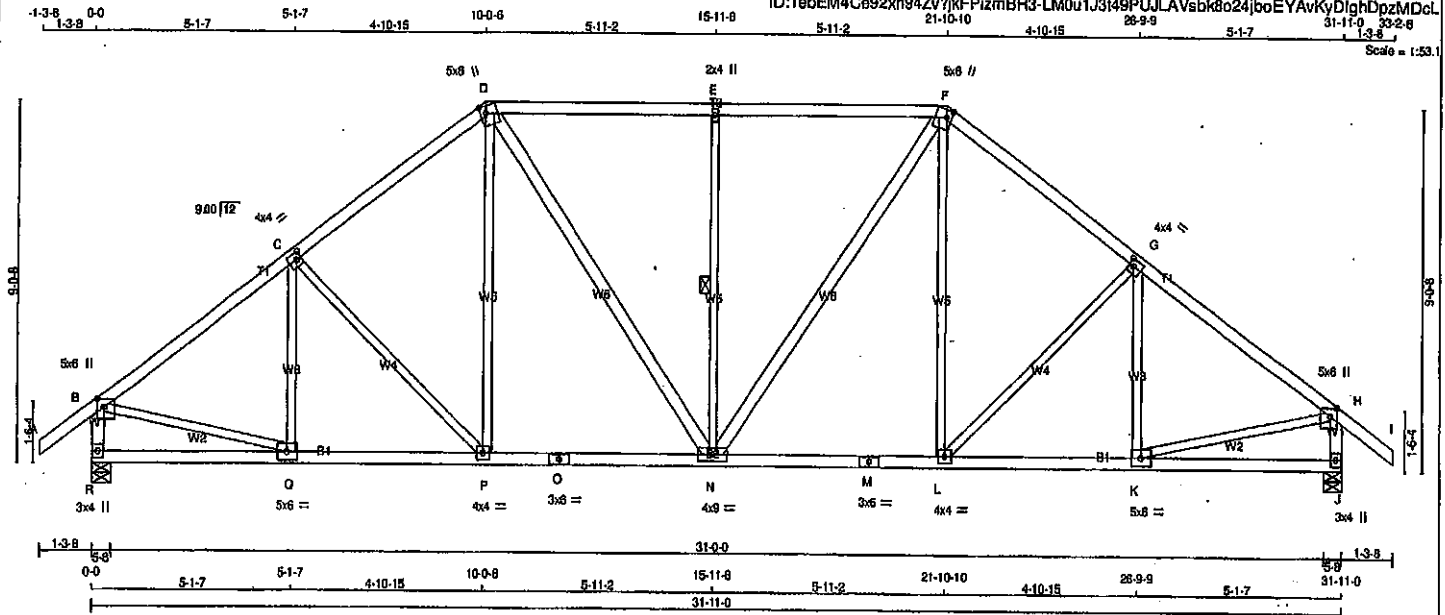

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMWV+p	MT20	5.0	6.0	2.50 2.00
C TMWW-1	MT20	4.0	4.0	2.00 1.50
D TTWW+m	MT20	5.0	6.0	2.25 1.50
E TMW+w	MT20	2.0	4.0	
F TTWW+m	MT20	5.0	6.0	2.25 1.50
G TMWW-1	MT20	4.0	4.0	2.00 1.50
H TMWV+p	MT20	5.0	6.0	2.50 2.00
J BMV1+p	MT20	3.0	4.0	
K BMWW-1	MT20	5.0	6.0	
L BMWW-1	MT20	4.0	4.0	
M BS-1	MT20	3.0	6.0	
N BMWWV-1	MT20	4.0	6.0	
O BS-1	MT20	3.0	6.0	
P BMWW-1	MT20	4.0	4.0	
Q BMWW-1	MT20	5.0	6.0	
R BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORIZ	BRG	BRG	IN-SX	IN-SX
R	1888	0	1888	0	0	5-8	5-8		
J	1888	0	1888	0	0	5-8	5-8		

UNFACTORED REACTIONS		1ST CASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
R	1331	887 / 0	0 / 0	0 / 0	0 / 0
J	1331	887 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.52 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING		TOTAL LOAD CASES: (4)	
CHORDS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)
FR-TO			
A-B	0 / 38	-91.8	-91.8 0.12 (1)
B-C	-1923 / 0	-91.8	-91.8 0.36 (1)
C-D	-1772 / 0	-91.8	-91.8 0.34 (1)
D-E	-1655 / 0	-91.8	-91.8 0.46 (1)
E-F	-1655 / 0	-91.8	-91.8 0.46 (1)
F-G	-1772 / 0	-91.8	-91.8 0.34 (1)
G-H	-1923 / 0	-91.8	-91.8 0.36 (1)
H-I	0 / 38	-91.8	-91.8 0.12 (1)
R-B	-1845 / 0	0.0	0.0 0.19 (1)
J-H	-1845 / 0	0.0	0.0 0.19 (1)
R-Q	0 / 0	-18.5	-18.5 0.10 (4)
Q-P	0 / 1584	-18.5	-18.5 0.31 (1)
P-O	0 / 1391	-18.5	-18.5 0.29 (1)
O-N	0 / 1391	-18.5	-18.5 0.29 (1)
N-M	0 / 1391	-18.5	-18.5 0.29 (1)
M-L	0 / 1391	-18.5	-18.5 0.29 (1)
L-K	0 / 1584	-18.5	-18.5 0.31 (1)
K-J	0 / 0	-18.5	-18.5 0.10 (4)

TOTAL WEIGHT = 2 X 158 = 311 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.08")
CALCULATED VERT. DEFL. (LL) = L/899 (0.07")
ALLOWABLE DEFL. (TL) = L/360 (1.08")
CALCULATED VERT. DEFL. (TL) = L/999 (0.13")

CSI: TC=0.46/1.00 (E-F:1), BC=0.31/1.00 (P-Q:1), WB=0.38/1.00 (B-C:1), SS=0.26/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1650

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.89 (B) (INPUT = 0.90)
JSI METAL = 0.45 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007736

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408164	T31	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 9 Oct 2019 MITek Industries, Inc. Tue Apr 28 10:55:37 2020 Page 1

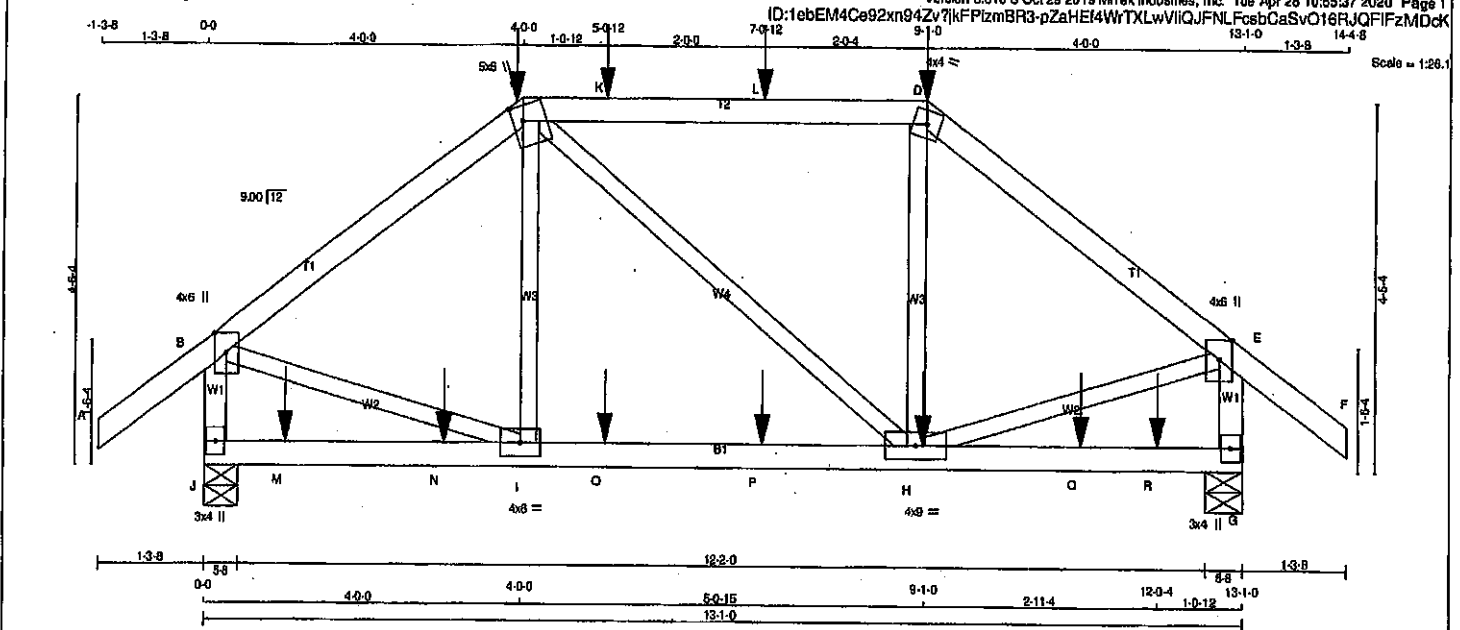

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - D	2x4	DRY	No.2	SPF		
D - F	2x4	DRY	No.2	SPF		
J - B	2x4	DRY	No.2	SPF		
G - E	2x4	DRY	No.2	SPF		
J - G	2x4	DRY	No.2	SPF		

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	6.0	Edge	
C	TTWW+m	MT20	5.0	6.0	2.25	1.50
D	TTW-m	MT20	4.0	4.0		
E	TMVW+p	MT20	4.0	6.0	Edge	
G	BMV1+p	MT20	3.0	4.0		
H	BMVWW-I	MT20	4.0	9.0		
I	BMVWW-I	MT20	4.0	6.0		
J	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE, TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
J	1153	0	1153	0
G	1177	0	1177	0

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW
J	813	547 / 0
G	831	558 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, G

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.63 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
PR-TO	A-B	0 / 38	-91.8	-91.8	0.14 (1)	10.00	I-C	-99 / 64	0.03 (1)
B-C	-982 / 0	-91.8	-91.8	0.30 (1)	5.91	C-H	0 / 25	0.01 (1)	
C-K	-785 / 0	-91.8	-91.8	0.63 (1)	5.63	H-D	-117 / 61	0.04 (1)	
K-L	-785 / 0	-91.8	-91.8	0.63 (1)	5.63	B-I	0 / 800	0.20 (1)	
L-D	-785 / 0	-91.8	-91.8	0.63 (1)	5.63	H-E	0 / 820	0.20 (1)	
D-E	-987 / 0	-91.8	-91.8	0.30 (1)	5.63				
E-F	0 / 38	-91.8	-91.8	0.14 (1)	10.00				
J-B	-1113 / 0	0.0	0.0	0.13 (1)	7.48				
G-E	-1133 / 0	0.0	0.0	0.13 (1)	7.43				
J-M	0 / 0	-18.5	-18.5	0.13 (4)	10.00				
M-N	0 / 0	-18.5	-18.5	0.13 (4)	10.00				
N-I	0 / 0	-18.5	-18.5	0.13 (4)	10.00				
I-O	0 / 786	-18.5	-18.5	0.20 (1)	10.00				
O-P	0 / 786	-18.5	-18.5	0.20 (1)	10.00				
P-H	0 / 786	-18.5	-18.5	0.20 (1)	10.00				
H-Q	0 / 0	-18.5	-18.5	0.13 (4)	10.00				
Q-R	0 / 0	-18.5	-18.5	0.13 (4)	10.00				
R-G	0 / 0	-18.5	-18.5	0.13 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-0	-31	-35	---	---	FRONT	VERT.	DEAD	---	C1
C	4-0-0	-135	-135	---	---	FRONT	VERT.	SNOW	---	C1
D	9-1-0	-31	-35	---	---	FRONT	VERT.	DEAD	---	C1
D	9-1-0	-74	-74	---	---	BACK	VERT.	TOTAL	---	C1
D	9-1-0	-135	-135	---	---	FRONT	VERT.	SNOW	---	C1
H	9-0-12	-13	-13	---	---	BACK	VERT.	TOTAL	---	C1
K	5-0-12	-67	-67	---	---	BACK	VERT.	TOTAL	---	C1
L	7-0-12	-67	-67	---	---	BACK	VERT.	TOTAL	---	C1
M	1-0-12	-13	-13	---	---	BACK	VERT.	TOTAL	---	C1
N	3-0-12	-13	-13	---	---	BACK	VERT.	TOTAL	---	C1
O	5-0-12	-13	-13	---	---	BACK	VERT.	TOTAL	---	C1
P	7-0-12	-13	-13	---	---	BACK	VERT.	TOTAL	---	C1
Q	11-0-12	-13	-13	---	---	BACK	VERT.	TOTAL	---	C1
R	12-0-4	-13	-13	---	---	BACK	VERT.	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN PLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.44")
CALCULATED VERT. DEFL. (LL) = U 999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.44")
CALCULATED VERT. DEFL. (TL) = U 999 (0.03")

CSI: TC=0.83/1.00 (C-D:1), BC=0.20/1.00 (H-I:1), WB=0.20/1.00 (E-H:1), SSI=0.27/1.00 (C-D:1)

OOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR, SECTION (PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.83 (E) (INPUT = 0.90)
JSI METAL = 0.52 (E) (INPUT = 1.00)




Structural component only
DWG# T-2007737

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408164	T32	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 28 2019 MTek Industries, Inc. Tue Apr 28 10:55:38 2020 Page 1

ID:1ebEM4Ce92xm94Zv7jKFPizmBR3-Hl8/S758cmfCYIKuz0mcuT98kbwteo3Fgz9oHizMDcl



Scale = 1:44.6

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
J - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
I - D	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMV-p	MT20	3.0	4.0
C	TMVW-1	MT20	4.0	4.0
D	TMVW-m	MT20	4.0	6.0
E	TMVW-1	MT20	4.0	4.0
F	TMV-p	MT20	3.0	4.0
H	BMVW-1	MT20	4.0	4.0
I	BMVW-1	MT20	4.0	9.0
J	BMVW-1	MT20	4.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED	MAXIMUM FACTORED	INPUT	RECORD	
	GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	DOWN	UPLIFT	IN-SX
J	848	0	848	0	5-8
H	848	0	848	0	5-8

UNFACTORED REACTIONS

1ST CASE	MAX/MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	597	405 / 0	0 / 0	0 / 0	0 / 0	192 / 0	0 / 0
H	597	405 / 0	0 / 0	0 / 0	0 / 0	192 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	MAX. FACTORED	MEMB.	MAX. FACTORED	FACTORED	MAX. FACTORED
	FORCE (LBS)	VERT. LOAD (PLF)	OSI (LC)		FORCE (LBS)	OSI (LC)	
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 38	-91.8	-91.8	0.12 (1)	10.00	I-D	0 / 253
B-C	0 / 21	-91.8	-91.8	0.16 (1)	10.00	C-I	-61 / 19
C-D	-424 / 0	-91.8	-91.8	0.12 (1)	8.28	I-E	-61 / 19
D-E	-424 / 0	-91.8	-91.8	0.12 (1)	8.28	J-C	-663 / 0
E-F	0 / 21	-91.8	-91.8	0.16 (1)	10.00	E-H	-663 / 0
F-G	0 / 38	-91.8	-91.8	0.12 (1)	10.00		
J-B	-242 / 0	0.0	0.0	0.04 (1)	7.81		
H-F	-242 / 0	0.0	0.0	0.04 (1)	7.81		
J-I	0 / 356	-18.5	-18.5	0.26 (4)	10.00		
I-H	0 / 356	-18.5	-18.5	0.26 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.44")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/380 (0.44")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.16/1.00 (E-F:1), BC=0.26/1.00 (H-I:4), WB=0.41/1.00 (C-J:1), SS=0.12/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1987 1686


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.77 (C) (INPUT = 0.90)
JSI METAL = 0.23 (C) (INPUT = 1.00)

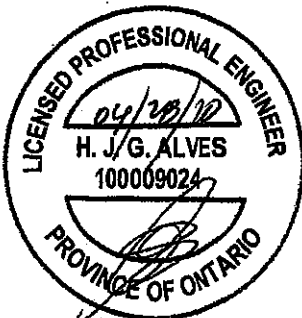

Structural component only
DWG# T-2007738

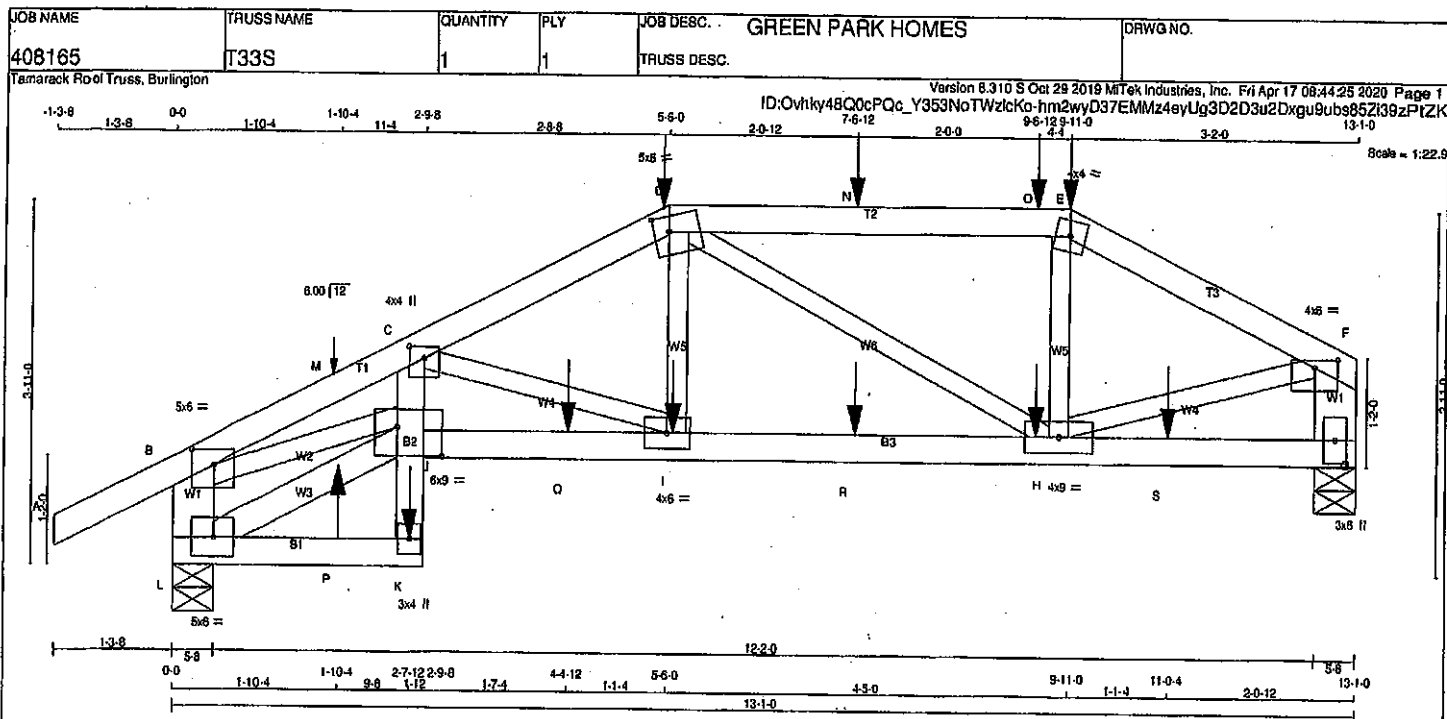

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
L - B	2x6	DRY	No.2	SPF
G - F	2x6	DRY	No.2	SPF
L - K	2x4	DRY	No.2	SPF
K - C	2x4	DRY	No.2	SPF
J - G	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
L - J	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (tablets in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	2.00	3.00
C	TMVW-p	MT20	4.0	4.0	1.50	2.00
O	TTWV-m	MT20	5.0	6.0	2.00	2.00
E	TTW-m	MT20	4.0	4.0		
F	TMVW-p	MT20	4.0	6.0	1.00	3.00
G	BMV1-p	MT20	3.0	6.0		
H	BMVWWV-t	MT20	4.0	6.0		
I	BMVWV-t	MT20	4.0	6.0		
J	BMVWWV-t	MT20	6.0	9.0	3.75	6.00
K	BMV-p	MT20	3.0	4.0		
L	BMVW1-t	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
G	1008	0	1008	0	5-8	5-8
L	1158	0	1158	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LOADE		MAX/MIN COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
G	711	480 / 0	0 / 0	0 / 0	0 / 0	231 / 0	0 / 0
L	814	560 / 0	0 / 0	0 / 0	0 / 0	254 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.21 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (7)

CHORDS			FACTORED			WEBS		
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (LBS)	VERT. LOAD (LBS)	LC1 MAX CSI (LC)	MAX. UNBRAC	MEMB.	MAX. FORCE (LBS)	FACTORED MAX CSI (LC)
FR-TO			FROM TO		LENGTH	FR-TO		
A-B	0 / 28		-91.8	-91.8	0.13 (1)	10.00	C-I	-939 / 0 0.20 (1)
B-M	-2420 / 0		-91.8	-91.8	0.21 (1)	4.21	I-D	0 / 396 0.10 (1)
M-C	-2420 / 0		-91.8	-91.8	0.21 (1)	4.21	D-H	-389 / 0 0.18 (1)
C-D	-1585 / 0		-91.8	-91.8	0.18 (1)	5.02	H-E	0 / 77 0.03 (4)
D-N	-1108 / 0		-91.8	-91.8	0.41 (1)	5.41	H-F	0 / 1141 0.28 (1)
N-O	-1108 / 0		-91.8	-91.8	0.41 (1)	5.41	L-J	-143 / 0 0.02 (1)
O-E	-1108 / 0		-91.8	-91.8	0.41 (1)	5.41	B-J	0 / 2178 0.54 (1)
E-F	-1238 / 0		-91.8	-91.8	0.20 (1)	5.51		
L-B	-1077 / 0		0.0	0.0	0.08 (1)	7.81		
G-F	-982 / 0		0.0	0.0	0.07 (1)	7.81		
L-P	0 / 131		-18.5	-18.5	0.05 (4)	10.00		
P-K	0 / 131		-18.5	-18.5	0.05 (4)	10.00		
K-J	0 / 203		0.0	0.0	0.27 (1)	10.00		
J-C	0 / 422		0.0	0.0	0.30 (1)	10.00		
J-Q	0 / 2314		-18.5	-18.5	0.43 (1)	10.00		
Q-I	0 / 2314		-18.5	-18.5	0.43 (1)	10.00		
I-R	0 / 1442		-18.5	-18.5	0.30 (1)	10.00		
R-H	0 / 1442		-18.5	-18.5	0.30 (1)	10.00		
H-S	0 / 0		-18.5	-18.5	0.07 (4)	10.00		
S-G	0 / 0		-18.5	-18.5	0.07 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LOC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
D	5-6-0	-178	-178	---	FRONT	VERT	TOTAL	---	C1
E	9-11-0	-154	-154	---	FRONT	VERT	TOTAL	---	C1
H	9-6-12	-7	-7	---	FRONT	VERT	TOTAL	---	C1
I	5-6-12	-7	-7	---	FRONT	VERT	TOTAL	---	C1
K	2-7-12	-184	-184	---	FRONT	VERT	TOTAL	---	C1
M	1-10-4	1	1	104	FRONT	VERT	TOTAL	---	C1
N	7-6-12	-17	-17	---	FRONT	VERT	TOTAL	---	C1
O	9-8-12	-47	-47	---	FRONT	VERT	TOTAL	---	C1
P	1-10-4	7	7	12	FRONT	VERT	TOTAL	---	C1
Q	4-4-12	-3	-3	---	FRONT	VERT	TOTAL	---	C1
R	7-6-12	-7	-7	---	FRONT	VERT	TOTAL	---	C1
S	11-0-4	-3	-3	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2012, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.44")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.44")
CALCULATED VERT. DEFL.(TL) = L/999 (0.10")

CSI: TC=0.41/1.00 (D-E:1), BC=0.43/1.00 (I-J:1), WB=0.54/1.00 (B-J:1), SS=0.22/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1987 789 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (J) (INPUT = 0.90)
JSI METAL= 0.49 (B) (INPUT = 1.00)

Structural component only
DWG# T-2006495

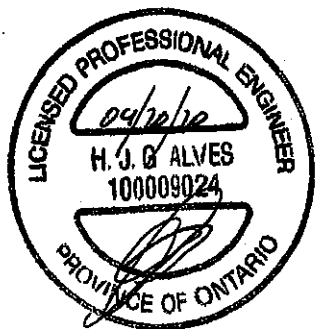

JOB NAME 408165	TRUSS NAME T34	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

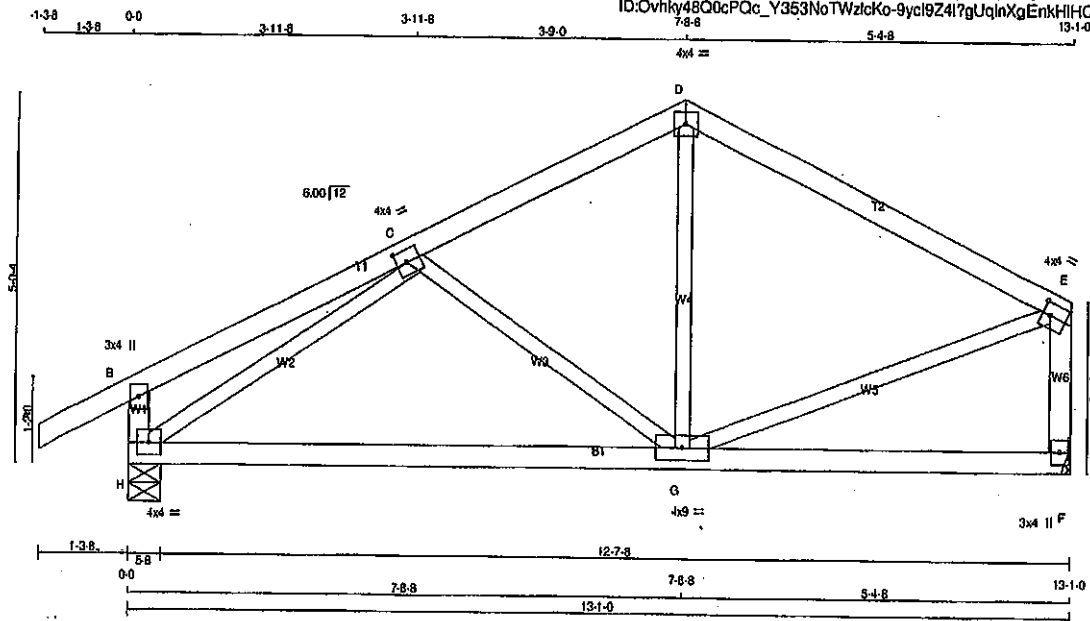

TOTAL WEIGHT = 4 X 52 = 207 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DRY
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
F - E	2x4	DRY	No.2
H - F	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)			
JT	TYPE	PLATES	W LEN Y X
B	TMV+p	MT20	3.0 4.0
C	TMVW-1	MT20	4.0 4.0 2.00 1.75
D	TTW-p	MT20	4.0 4.0
E	TMVW-1	MT20	4.0 4.0 2.00 1.25
F	BMV1+p	MT20	3.0 4.0
G	BMVWW-1	MT20	4.0 9.0
H	BMVW1-1	MT20	4.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG	
F	VERT	HORZ	DOWN	HORZ	UPLIFT
F	721	0	721	0	0
H	846	0	846	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	DEAD	SOIL
F	510	335 / 0	0 / 0	175 / 0
H	598	404 / 0	0 / 0	192 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNSHACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED	VERT. LOAD	LC1 MAX	MEMB.	MAX. FACTORED
FR-TO	FORCE (LBS)	(PLF)	CSI (LC)	FR-TO	FORCE (LBS)
A-B	0 / 28	-91.8	-91.8 0.12 (1)	C-G	-275 / 0
B-C	0 / 18	-91.8	-91.8 0.21 (1)	G-D	0 / 124
C-D	-594 / 0	-91.8	-91.8 0.17 (1)	H-C	-398 / 0
D-E	-568 / 0	-91.8	-91.8 0.34 (1)	G-E	0 / 541
H-B	-262 / 0	0.0	0.0 0.03 (1)		
F-E	-690 / 0	0.0	0.0 0.09 (1)		
H-G	0 / 728	-18.5	-18.5 0.30 (4)		
G-F	0 / 0	-18.5	-18.5 0.25 (4)		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.44")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.01")
ALLOWABLE DEFL. (TL) = $L/360$ (0.44")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.10")

CSI: TC=0.34/1.00 (D-E:1), BC=0.30/1.00 (G-H:4), WB=0.33/1.00 (C-H:1), SS=0.17/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (E) (INPUT = 0.90)
JSI METAL= 0.28 (C) (INPUT = 1.00)

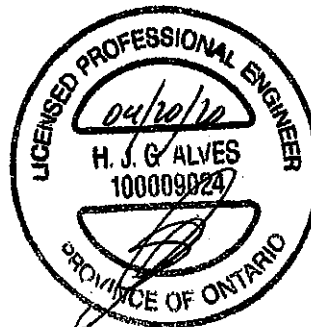


Structural component only
DWG# T-2006496

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408165	T34CP	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.316 S Oct 29 2019 MTEK Industries, Inc. Fri Apr 17 08:44:27 2020 Page 1
ID:Ovhky48Q0cPQc_Y353NoTWzlcKo-d8AhNu4NmzchJx8toUFWUzOkkOodrm8bP2p71zPtZl

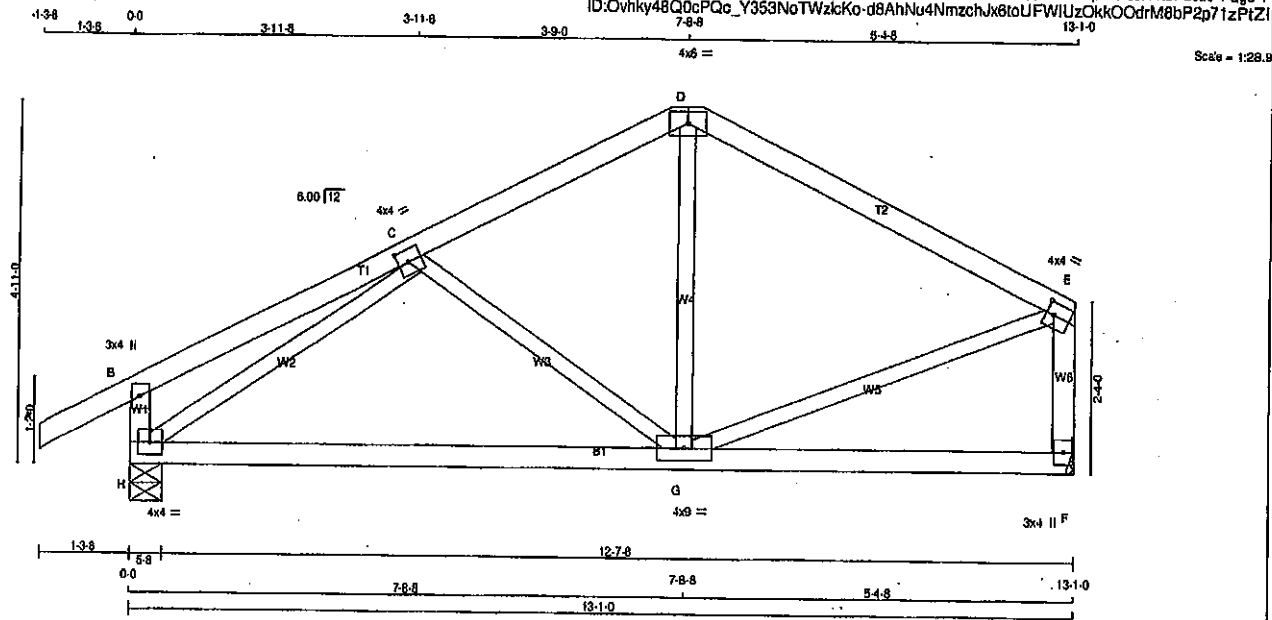

Scale = 1:28.8

LUMBER				N. L. G. A. RULES	
CHORDS	SIZE	DRY	LUMBER	DESCR.	
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
H - B	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-t	MT20	4.0	4.0	2.00	1.75
D	TTW-p	MT20	4.0	6.0		
E	TMVW-t	MT20	4.0	4.0	2.00	1.25
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-t	MT20	4.0	9.0		
H	BMVW1-t	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HOZ
F	721	0	721	0
H	846	0	846	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

	1ST LOASE	MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	510	335/0	0/0	0/0	0/0	175/0	0/0
H	596	404/0	0/0	0/0	0/0	192/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED		MEMB.	MAX. FACTORED	FACTORED	
	FORCE	VERT. LOAD LC1	MAX		FORCE	MAX	
	(LBS)	(PLF)	CSI (LC)		(LBS)	CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0/28	-91.8	-91.8 0.12 (1)	10.00	C-G	-275/0	0.10 (1)
B-C	0/18	-91.8	-91.8 0.21 (1)	10.00	G-D	0/124	0.04 (4)
D-E	-594/0	-91.8	-91.8 0.17 (1)	8.25	H-C	-698/0	0.33 (1)
D-E	-598/0	-91.8	-91.8 0.34 (1)	8.25	G-E	0/541	0.12 (1)
H-B	-262/0	0.0	0.0 0.03 (1)	7.81			
F-E	-690/0	0.0	0.0 0.09 (1)	7.81			
H-G	0/728	-18.5	-18.5 0.30 (4)	10.00			
G-F	0/0	-18.5	-18.5 0.25 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(56 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/389 (0.44")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/389 (0.44")
CALCULATED VERT. DEFL.(TL) = L/999 (0.10")

CSI: TC=0.34/1.00 (D-E:1), BC=0.30/1.00 (G-H:4),
WB=0.33/1.00 (C-H:1), SS=0.17/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 384	1887 788	1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (E) (INPUT = 0.90)
JSI METAL = 0.28 (C) (INPUT = 1.00)

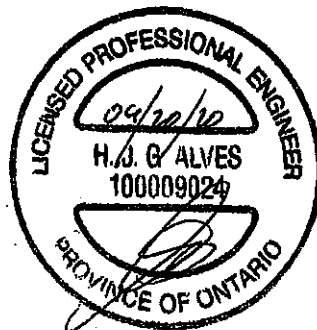

Structural component only
DWG# T-2006497

CALCULATED VERT. DEF.(TL) = 1.784 (0.48")

CSI: TC=0.81/1.00 (E-G:1), BC=0.73/1.00 (M-O:1),
WB=0.78/1.00 (H-M:1), SSI=0.33/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVEHEELS OFF

TRUSS PLATE MANUFACTURER IS NOT
RESPONSIBLE FOR QUALITY CONTROL IN THE
TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	818 354	1667 788	1887 1658

PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (Q) (INPUT = 0.90)
JSI METAL= 0.94 (N) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408164	T300	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 28 2019 Mike Industries, Inc. Tue Apr 28 10:55:39 2020 Page 2
ID:1ebEM4Ce92xn94Zv7ikFPizmBR3-k1i1fL5mM4n3Apv4XkHrQdICR78hNAmPvdvMp8zMDcl

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
U	18-10-4	-67	-67	---	FRONT	VERT	TOTAL	---	C1
V	20-10-4	-67	-67	---	FRONT	VERT	TOTAL	---	C1
W	22-10-4	-67	-67	---	FRONT	VERT	TOTAL	---	C1
X	24-10-4	-67	-67	---	FRONT	VERT	TOTAL	---	C1
Y	26-10-4	-67	-67	---	FRONT	VERT	TOTAL	---	C1
Z	14-10-4	-13	-13	---	FRONT	VERT	TOTAL	---	C1
AA	16-10-4	-13	-13	---	FRONT	VERT	TOTAL	---	C1
AB	18-10-4	-13	-13	---	FRONT	VERT	TOTAL	---	C1
AC	20-10-4	-13	-13	---	FRONT	VERT	TOTAL	---	C1
AD	22-10-4	-13	-13	---	FRONT	VERT	TOTAL	---	C1
AE	24-10-4	-13	-13	---	FRONT	VERT	TOTAL	---	C1
AF	26-10-4	-13	-13	---	FRONT	VERT	TOTAL	---	C1
AG	30-10-4	-13	-13	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2007739 72

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC	GREEN PARK HOMES	DRWG NO.
408165	T320	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Mon May 11 09:05:34 2020 Page 1
 ID:Ovhky48Q0cPQc_Y353NoTWzlcKo-zQnmX4RMKU4AM5xqJdW?ca7bd3efqkAPTSPdZhdvV

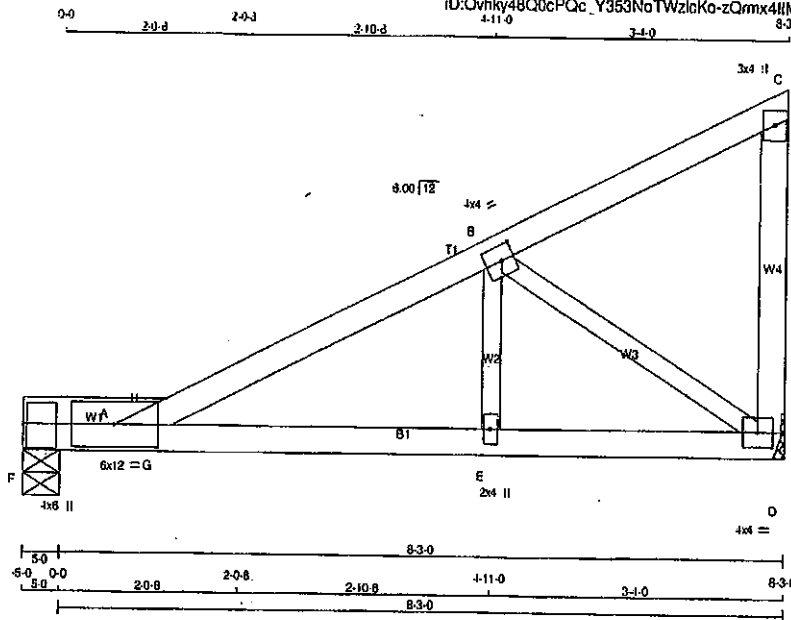

Scale = 1/23

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
D - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
F - A	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
A	BMWm	MT20	6.0	12.0			
B	BMWw	MT20	4.0	4.0	2.00	1.75	
C	BMVp	MT20	3.0	4.0			
D	BMVWt	MT20	4.0	4.0			
E	BMVw	MT20	2.0	4.0			
F	BMVWt+m	MT20	4.0	6.0	3.25	0.50	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
D	478	0	478	0
F	478	0	478	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	338	222	0	0	0	0	116	0
F	338	222	0	0	0	0	118	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	WEBS	MAX. FACTORED	MAX
		FORCE		(PLF)	CSI	(LC)	UNBRAC			FORCE	MAX
		(LBS)					LENGTH			(LBS)	CSI
FR-TO							FR-TO				
A-H	-831	0	-91.8	-91.8	0.21	(1)	6.25	E-B	0	195	0.04
H-B	-827	0	-91.8	-91.8	0.29	(1)	6.25	B-D	-715	0	0.18
B-C	-27	0	-91.8	-91.8	0.21	(1)	6.25	G-H	0	281	0.00
D-C	-83	0	0.0	0.0	0.02	(1)	7.81				
F-A	0	0	-110.3	-110.3	0.25	(1)	10.00				
A-G	0	602	-18.5	-18.5	0.69	(1)	10.00				
G-E	0	602	-18.5	-18.5	0.47	(1)	10.00				
E-D	0	602	-18.5	-18.5	0.23	(1)	10.00				

TOTAL WEIGHT = 4 X 30 = 119 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
DL	=	6.0	PSF	
BOT CH.	LL	=	0.0	PSF
DL	=	7.4	PSF	
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2010, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.29")
 CALCULATED VERT. DEFL. (LL) = L/999 (0.08")
 ALLOWABLE DEFL. (TL) = L/360 (0.29")
 CALCULATED VERT. DEFL. (TL) = L/708 (0.15")

CSI: TC=0.29/1.00 (B-H:1), SC=0.69/1.00 (A-G:1), WB=0.18/1.00 (B-D:1), SS=0.30/1.00 (A-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	616	354	1667
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.65 (D) (INPUT = 0.90)
 JSI METAL= 0.26 (A) (INPUT = 1.00)



Structural component only
 DWG# T-2009109

JOB NAME 408163	TRUSS NAME PB1	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version B.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:46:31 2020 Page 1 ID:KIHNL7kiAuBVUgBrpQW7E8ds6y-7?iZQla9Z4E5B7bi3XUbj66cZlnKh7iP6i4NurzPikM	

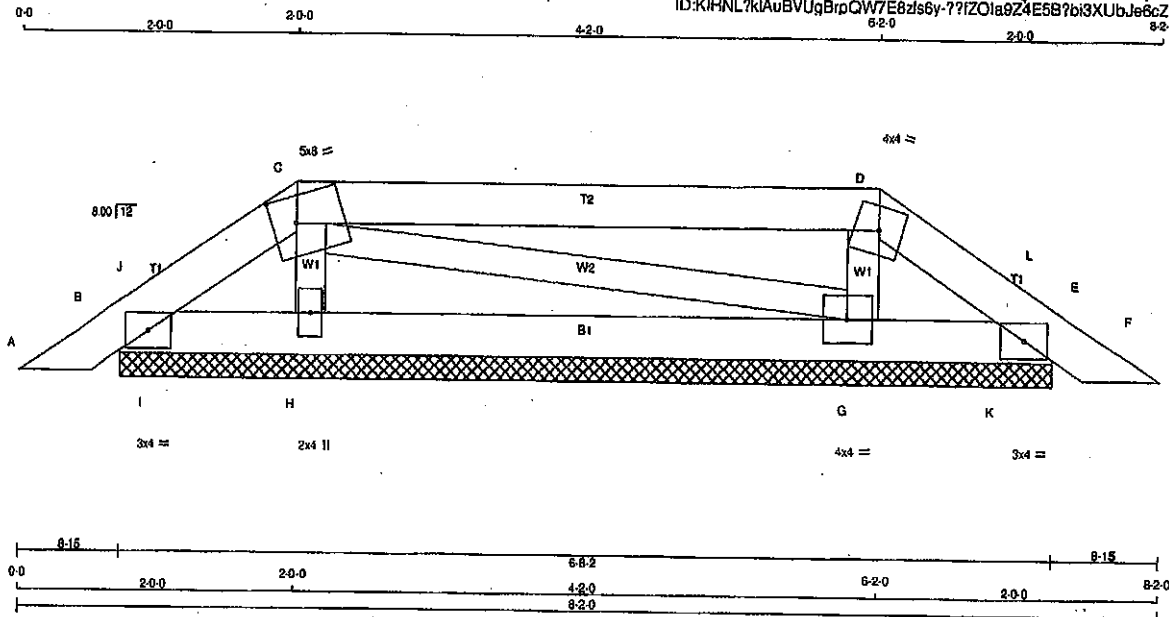

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF
C - D	2x4 DRY	No.2	SPF
D - F	2x4 DRY	No.2	SPF
B - E	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMB1-I	MT20	3.0	4.0	
C	TTWW-m	MT20	5.0	6.0	2.25 2.00
D	TTW-m	MT20	4.0	4.0	
E	TMB1-I	MT20	3.0	4.0	
G	BMW1-I	MT20	4.0	4.0	
H	BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	UP	BRG	IN-SX	BRG	IN-SX
B	145	0	145	0	0	6-8.2	6-8.2	6-8.2	6-8.2
E	141	0	141	0	0	6-8.2	6-8.2	6-8.2	6-8.2
H	283	0	283	0	0	6-8.2	6-8.2	6-8.2	6-8.2
G	289	0	289	0	0	6-8.2	6-8.2	6-8.2	6-8.2

UNFACTORED REACTIONS

1ST LOASE		MAX/MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
B	99	83 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0	
E	97	81 / 0	0 / 0	0 / 0	0 / 0	16 / 0	0 / 0	
H	202	121 / 0	0 / 0	0 / 0	0 / 0	81 / 0	0 / 0	
G	206	125 / 0	0 / 0	0 / 0	0 / 0	81 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 15	-91.8 -91.8	0.03 (1)	10.00	H-C	-203 / 0	0.03 (1)
B-J	-44 / 0	-91.8 -91.8	0.01 (4)	6.25	C-G	-5 / 0	0.00 (1)
J-C	-51 / 0	-91.8 -91.8	0.01 (1)	6.25	G-D	-208 / 0	0.03 (1)
C-D	-11 / 0	-91.8 -91.8	0.27 (1)	6.25	I-J	-88 / 0	0.00 (1)
D-L	-45 / 0	-91.8 -91.8	0.01 (1)	6.25	K-L	-89 / 0	0.00 (1)
L-E	-37 / 2	-91.8 -91.8	0.01 (4)	6.25			
E-F	0 / 15	-91.8 -91.8	0.03 (1)	10.00			
B-I	0 / 40	-18.5 -18.5	0.03 (1)	10.00			
I-H	0 / 40	-18.5 -18.5	0.05 (4)	10.00			
H-G	0 / 17	-18.5 -18.5	0.05 (4)	10.00			
G-K	0 / 35	-18.5 -18.5	0.05 (4)	10.00			
K-E	0 / 35	-18.5 -18.5	0.03 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.27/1.00 (C-D:1), BC=0.05/1.00 (H-I:4), WB=0.03/1.00 (D-G:1), SSI=0.15/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1856


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.16 (D) (INPUT = 0.90)
JSI METAL=0.05 (C) (INPUT = 1.00)

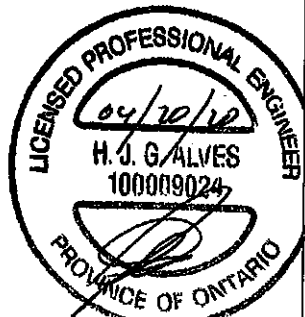

Structural component only
DWG# T-2008466

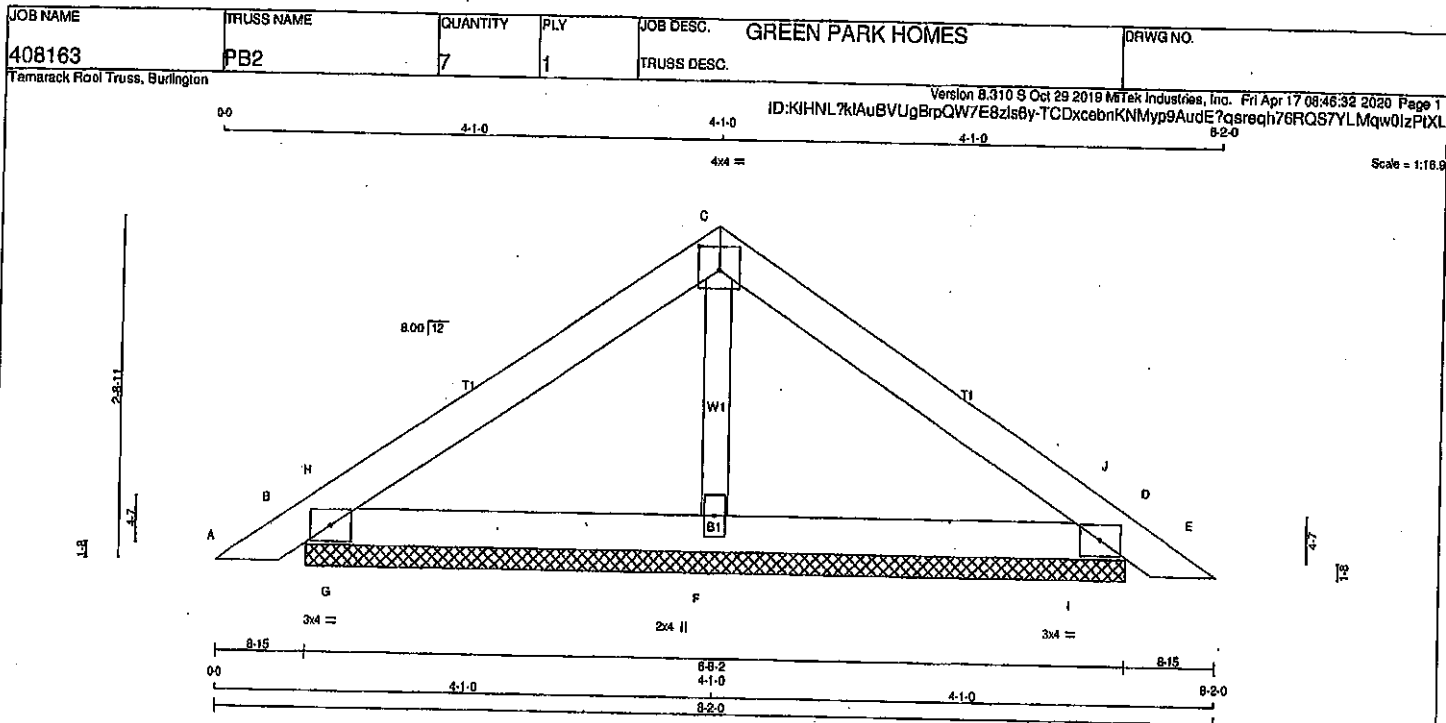

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER DESCR.
A - C 2x4 DRY No.2 SPF
C - E 2x4 DRY No.2 SPF
B - D 2x4 DRY No.2 SPF
ALL WEBS 2x3 DRY No.2 SPF
DRY: SEASONED LUMBER.

PLATES (table is in inches)
JT TYPE PLATES W LEN Y X
B TMB1-J MT20 3.0 4.0
C TTW-P MT20 4.0 4.0 2.25 2.00
D TMB1-J MT20 3.0 4.0
F BMW1-W MT20 2.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
B	284	0	284	0	6-8-2	6-8-2
D	284	0	284	0	6-8-2	6-8-2
F	291	0	291	0	6-8-2	6-8-2

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	SNOW	LIVE	PERM	LIVE			
B	198	142 / 0	0 / 0	0 / 0	0 / 0	58 / 0	0 / 0
D	198	142 / 0	0 / 0	0 / 0	0 / 0	58 / 0	0 / 0
F	208	125 / 0	0 / 0	0 / 0	0 / 0	63 - 0	0 - 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)		FACTORED VERT. LOAD (LBS)		MAX. FACTORED CS (LC)		WEBS MAX. FACTORED FORCE (LBS)		MAX. FACTORED CS (LC)	
	FR-TO	FR-TO	FR-TO	FR-TO	FR-TO	FR-TO	FR-TO	FR-TO	FR-TO	FR-TO
A-B	0 / 15	-91.8	-91.8	0.03 (1)	10.00	F-C	-138 / 0	0.02 (1)		
B-H	-32 / 0	-91.8	-91.8	0.05 (1)	8.25	G-H	-278 / 0	0.00 (1)		
H-C	-111 / 0	-91.8	-91.8	0.12 (1)	8.25	I-J	-278 / 0	0.00 (1)		
C-J	-111 / 0	-91.8	-91.8	0.12 (1)	8.25					
J-D	-32 / 0	-91.8	-91.8	0.05 (1)	8.25					
D-E	0 / 15	-91.8	-91.8	0.03 (1)	10.00					
B-G	0 / 88	-18.5	-18.5	0.12 (1)	10.00					
G-F	0 / 88	-18.5	-18.5	0.12 (1)	10.00					
F-I	0 / 88	-18.5	-18.5	0.12 (1)	10.00					
I-D	0 / 88	-18.5	-18.5	0.12 (1)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (C-H:1), BC=0.12/1.00 (B-G:1), WB=0.02/1.00 (C-F:1), SS=0.21/1.00 (B-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg


JSI GRIP = 0.24 (B) (INPUT = 0.90)
JSI METAL = 0.08 (B) (INPUT = 1.00)

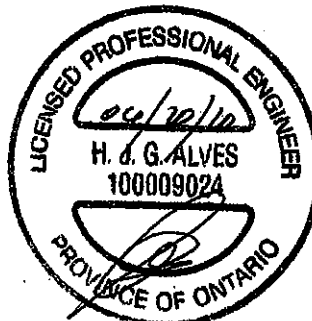

Structural component only
DWG# T-2006467

JOB NAME 408163	TRUSS NAME J1	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:48:21 2020 Page 1
 ID: KIHNL7kIAuBVUgBrpQW7E8zls6y-H43nItUw?zW?TqnTQIfvXhxOhMTLtkwp8f7RzPlXW
 1-9-7 1-10-8
 Scale = 1:15.8

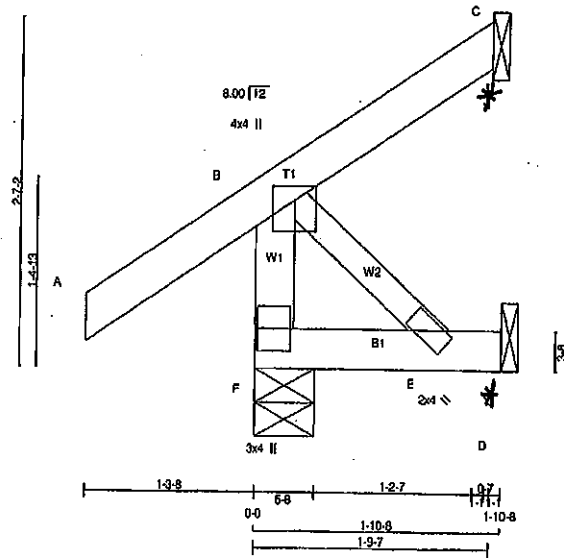

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
E	BMW+w	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	REQD BRG IN-SX
F	274	274	5-8	5-8
C	34	34	1-8	1-8
D	17	19	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D
 PROVIDE ANCHORAGE AT BEARING JOINT C FOR 180 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	190	143/0	0/0	0/0	0/0	47/0	0/0	0/0
C	23	19/27	0/0	0/0	0/0	4/0	0/0	0/0
D	14	0/0	0/0	0/0	0/0	14/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
 TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
F-B	-258/0	0.0	0.0 0.03 (1)	7.81	0/0	0.00 (1)	
A-B	0/35	-91.8	-91.8 0.12 (1)	10.00			
B-C	-27/0	-91.8	-91.8 0.12 (1)	8.25			
F-E	0/0	-18.5	-18.5 0.02 (4)	10.00			
E-D	0/0	-18.5	-18.5 0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 9 = 27 lb

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBCO 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
 - OVERHANG NOT TO BE ALTERED OR CUT OFF.

(56% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
 ALLOWABLE DEFL.(TL) = L/360 (0.19")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (E-F:4), WB=0.00/1.00 (B-E:1), SS=0.09/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	610 354 1867 788 1987 1656	

PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.18 (B) (INPUT = 0.80)
 JSI METAL = 0.05 (B) (INPUT = 1.00)

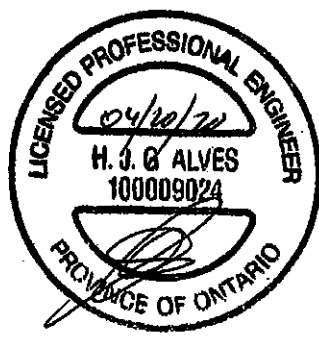

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Fri Apr 17 08:46:22 2020 Page 1
lgBrpQW7E8zls6y-lGc9WDTWhJ5NccPz18pUSkE4a5i4w.41oPOgtzPtXV

Scale = 1:22.6

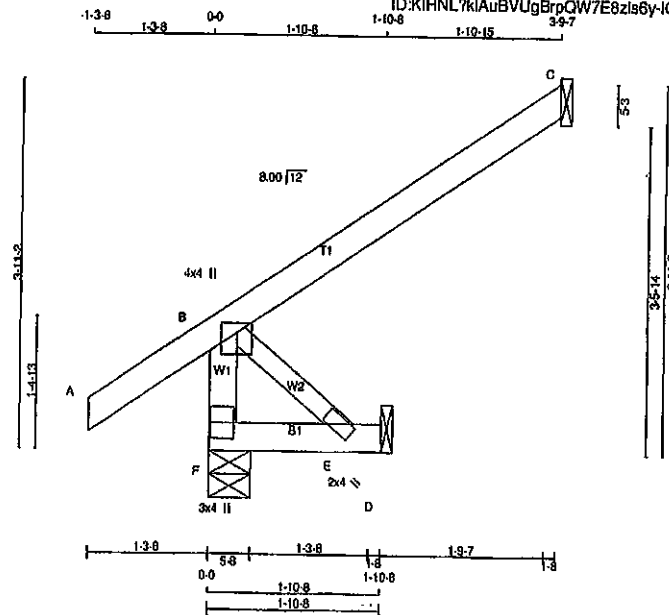

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR
F - B	2x4	DRY No.2	SPF
A - C	2x4	DRY No.2	SPF
F - D	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
E	BMW+w	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT	REQD	
GROSS REACTION		GROSS REACTION		BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
F	317	0	317	0	0	5-8
C	174	0	174	0	0	1-8
D	17	0	19	0	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST CASE		MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	220	167 / 0	0 / 0	0 / 0	0 / 0	53 / 0	0 / 0
C	120	97 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0
D	14	0 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBB			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO		FR-TO			
F-B	-300 / 0	0.0	0.0	0.03 (1)	7.81	0 / 0	0.00 (1)
A-B	0 / 35	-91.8	-91.8	0.13 (5)	10.00		
B-C	0 / 0	-91.8	-91.8	0.22 (1)	10.00		
F-E	0 / 0	-18.5	-18.5	0.02 (4)	10.00		
E-D	0 / 0	-18.5	-18.5	0.01 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.8	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD		=	39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(56 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.22/1.00 (B-C:1), BC=0.02/1.00 (E-F:4),
WB=0.00/1.00 (B-E:1), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.21 (B) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)

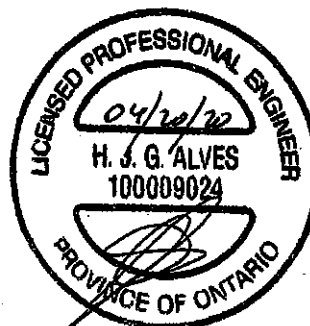

Structural component only
DWG# T-2006459

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408163	J3	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 08:46:24 2020 Page 1
ID:KIHNL7kIAuBVUgBrpQW7E8zls6y-lfkvvVmDwM5swZM9ZsyX9JSovMYyqTNV6uVklzPIXt
5-10-8

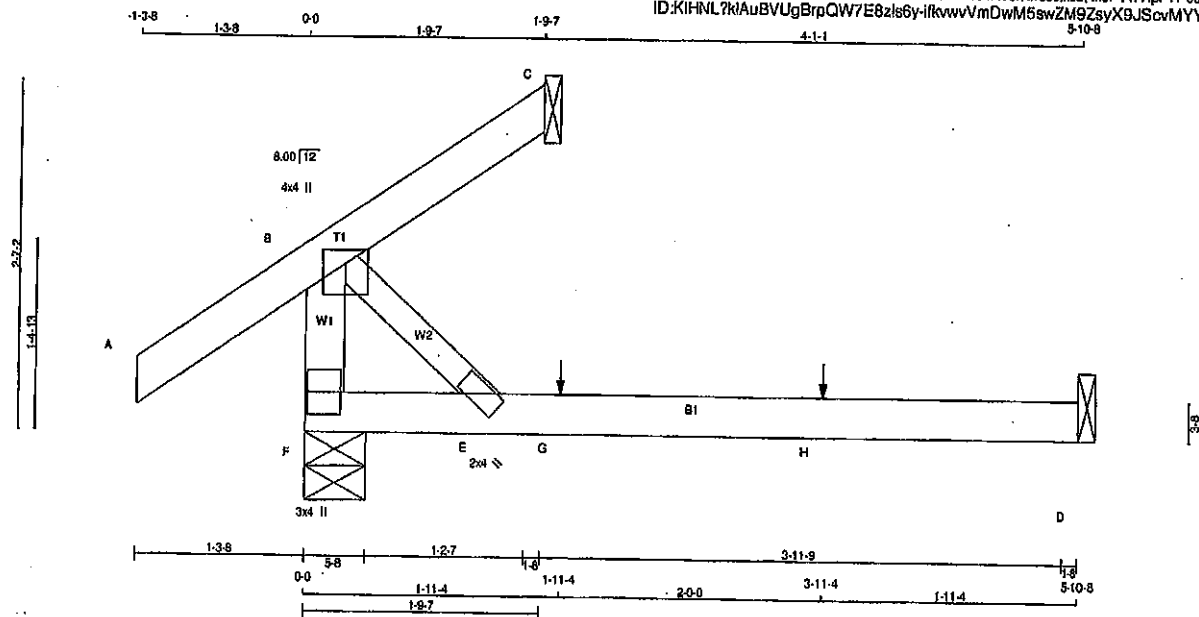

Scale = 1:15.8

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMV+w	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD.
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
F	311	0	311	0	5-8
C	34	0	34	0	1-8
D	54	0	61	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) F, C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	220	143 / 0	0 / 0	0 / 0	0 / 0	77 / 0	0 / 0	0 / 0
C	23	19 / 0	0 / 0	0 / 0	0 / 0	4 / 0	0 / 0	0 / 0
D	43	0 / 0	0 / 0	0 / 0	0 / 0	43 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX	MEMB.	FORCE (LBS)
F-B	-256 / 0	0.0	0.0 0.03 (1)	B-E	0 / 0
A-B	0 / 35	-91.8	-91.8 0.13 (1)		
B-C	-27 / 0	-91.8	-91.8 0.12 (1)		
F-E	0 / 0	-18.5	-18.5 0.13 (4)		
E-G	0 / 0	-18.5	-18.5 0.19 (4)		
G-H	0 / 0	-18.5	-18.5 0.19 (4)		
H-D	0 / 0	-18.5	-18.5 0.19 (4)		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
G	1-11-4	1	1	---	FRONT	VERT	TOTAL	C1
H	3-11-4	1	1	---	FRONT	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GIG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2019, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CS: TC=0.13/1.00 (A-B:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.09/1.00 (B-C:1)

DOL LUMBER=0.98 NAIL=0.98 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1887 1858

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.18 (B) (INPUT = 0.90)
JSI METAL = 0.05 (B) (INPUT = 1.00)

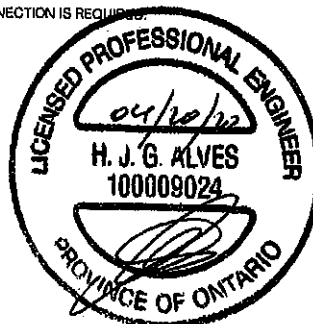


Structural component only
DWG# T-2006460

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408163	J4	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 5 Oct 2019 Mitek Industries, Inc. Fri Apr 17 08:46:25 2020 Page 1
ID:KIHNL7kiAuBVUgBrpQW7E8zls8y-ArIH8FWO_EUxT47YIGNB4NsbqJinHHJWkmd2GCzPIXs

Scale = 1:22.5

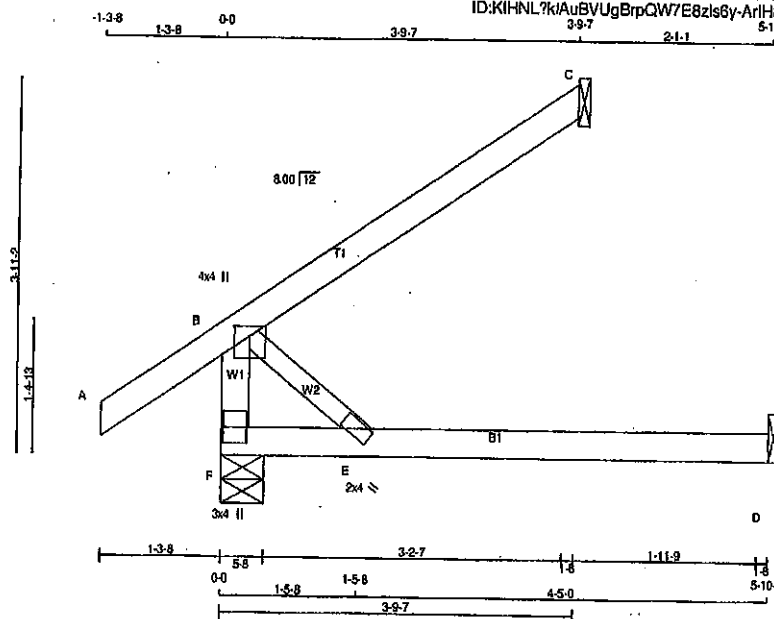

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
F - B	2x4 DRY	No.2	SPF
A - C	2x4 DRY	No.2	SPF
F - D	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
8	TMVW+p	MT20	4.0	4.0 1.25 2.00
E	BMVW+p	MT20	2.0	4.0
F	BMVW+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
F	354	0	354	0	5-8	5-8	5-8	5-8
C	174	0	174	0	1-8	1-8	1-8	1-8
D	54	0	61	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOASE		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
F	250	167 / 0	0 / 0	0 / 0	0 / 0	83 / 0	0 / 0
C	120	97 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0
D	43	0 / 0	0 / 0	0 / 0	0 / 0	43 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		WEBS		MAX. FACTORED	
	MAX. FORCE (LBS)	VERT. LOAD (LBS)	MAX. LOAD (LBS)	MAX. CS (LC)	MEMB. MAX. FORCE (LBS)	MAX. CS (LC)	MAX. FORCE (LBS)	MAX. CS (LC)
F-B	-300 / 0	0.0	0.0	0.03 (1)	7.61	0.00 (1)	0 / 0	0.00 (1)
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00			
B-C	0 / 0	-91.8	-91.8	0.22 (1)	10.00			
F-E	0 / 0	-18.5	-18.5	0.14 (4)	10.00			
E-D	0 / 0	-18.5	-18.5	0.19 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = U380 (0.20")
CALCULATED VERT. DEFL. (LL) = U389 (0.00")
ALLOWABLE DEFL. (TL) = U380 (0.20")
CALCULATED VERT. DEFL. (TL) = U389 (0.05")

CSI: TC=0.22/1.00 (B-C:1), BC=0.19/1.00 (D-E:1), WB=0.00/1.00 (B-E:1), CSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (B) (INPUT = 0.90)
JSI METAL = 0.08 (B) (INPUT = 1.00)

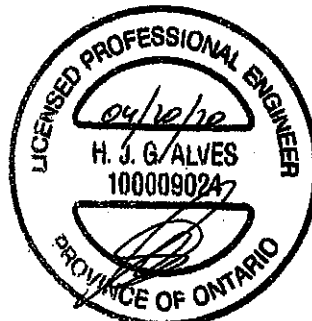


Structural component only
DWG# T-2006461

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408163	J5	11	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:46:28 2020 Page 1
ID:KIHNL?kIAuBVUgBrpQW7E8zIs6y-e2sgLbX0lXcoSEikG_uQcaOhfi100kzgyQNcpezPIXR

Scale = 1:28.8

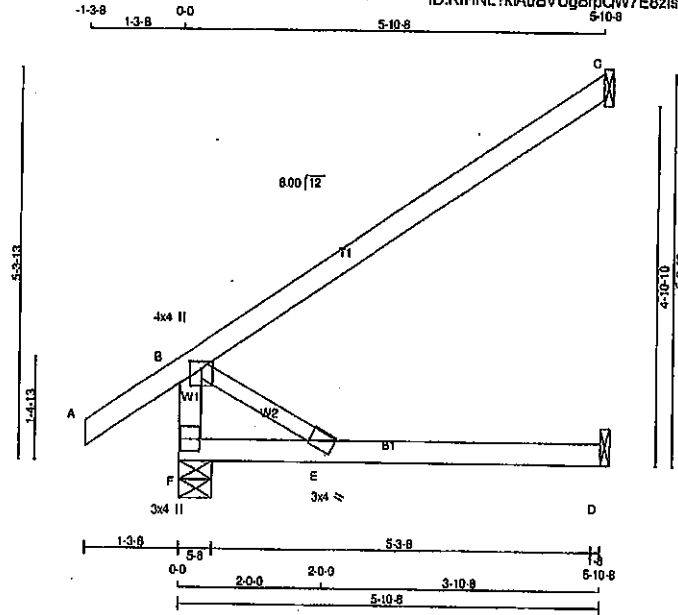

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	SPF	
F - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMVW+p	MT20	3.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
F	450	0	450	0	0	5-8	5-8		
C	270	0	270	0	0	1-8	1-8		
D	54	0	61	0	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST LCASE		MAX/MIN. COMPONENT REACTIONS		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	JT	COMBINED	SNOW	LIVE
F	318	221 / 0	0 / 0	0 / 0	0 / 0	95 / 0	0 / 0	F	318	221 / 0	0 / 0
C	186	150 / 0	0 / 0	0 / 0	0 / 0	35 / 0	0 / 0	C	186	150 / 0	0 / 0
D	43	0 / 0	0 / 0	0 / 0	0 / 0	43 / 0	0 / 0	D	43	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		W E B S		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX
FR-TO		FROM	TO	FR-TO		FROM	TO
F-B	-395 / 0	0.0	0.0 0.04 (1)	B-E	0 / 0	0.00 (1)	
A-B	0 / 35	-91.8	-91.8 0.12 (1)				
B-C	0 / 0	-91.8	-91.8 0.54 (1)				
F-E	0 / 0	-18.5	-18.5 0.17 (4)				
E-D	0 / 0	-18.5	-18.5 0.19 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.05")

CSI: TC=0.54/1.00 (B-C:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SSI=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	818	354	1887 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.28 (B) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006462

JOB NAME	TRUSS NAME	QUANTITY	PLY.	JOB DESC.	DRWG NO.
408163	J6	5	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Fri Apr 17 08:48:27 2020 Page 1
ID:KIHNL7kiAuBVUgBrpQW7E8zls6y-6EQ2ZxXWkIjOHxqhPI9oxzs6PpIBDpB469L4zPtXQ

Scale = 1:16.8

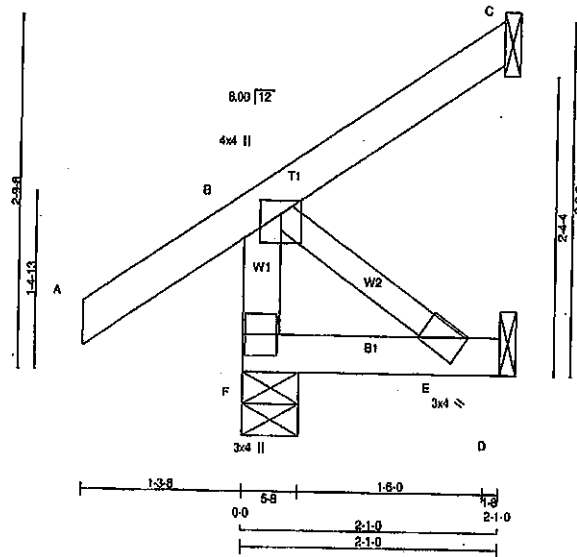

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS	2x4	No.2	SPF
F - B	2x4	DRY	SPF
A - C	2x4	DRY	SPF
F - D	2x4	DRY	SPF
ALL WEBS	2x3	DRY	SPF
DRY: SEASONED LUMBER.			

PLATES (table is in inches)			
JT TYPE	PLATES	W	LEN Y X
B	TMVW+p	MT20	4.0 4.0 1.25 2.00
E	BMVW+p	MT20	3.0 4.0
F	BMVW+p	MT20	3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
F	241	0	241	0	5-8	5-8	5-8	5-8
C	96	0	96	0	1-8	1-8	1-8	1-8
D	19	0	22	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOASE		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
F	168	124 / 0	0 / 0	0 / 0	0 / 0	44 / 0	0 / 0
C	66	63 / 0	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0
D	15	0 / 0	0 / 0	0 / 0	0 / 0	15 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		FACTORED		WEBS		FACTORED	
	MAX.	FORCE	VERT. LOAD	LG1 MAX	MAX.	MEMB.	MAX.	FORCE
FR-TO		(LBS)		(PLF)	CSI (LC)	UNBRAC	LENGTH	FR-TO
F-B	-222 / 0		0.0	0.0	0.02 (1)	7.81	B-E	0 / 0
A-B	0 / 35		-91.8	-91.8	0.12 (5)	10.00		
B-C	0 / 0		-91.8	-91.8	0.07 (1)	10.00		
F-E	0 / 0		-18.5	-18.5	0.02 (4)	10.00		
E-D	0 / 0		-18.5	-18.5	0.02 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 5 X 10 = 49 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:5), BC=0.02/1.00 (E-F:4), WB=0.00/1.00 (B-E:1), SSI=0.00/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1687
	788	1687	1056

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP = 0.15 (B) (INPUT = 0.90)
JSI METAL = 0.05 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006463

JOB NAME 408163 Tamarack Roof Truss, Burlington	TRUSS NAME J7	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---	------------------	---------------	----------	-------------------------------	-------------	----------

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 08:46:20 2020 Page 1
ID:KIHNL7kIAuBVUGBrpQW7E8zIs6y-aQ_QmGYHH9sWKXs70Owui?U5rWimUeTyQksIXzPiXP

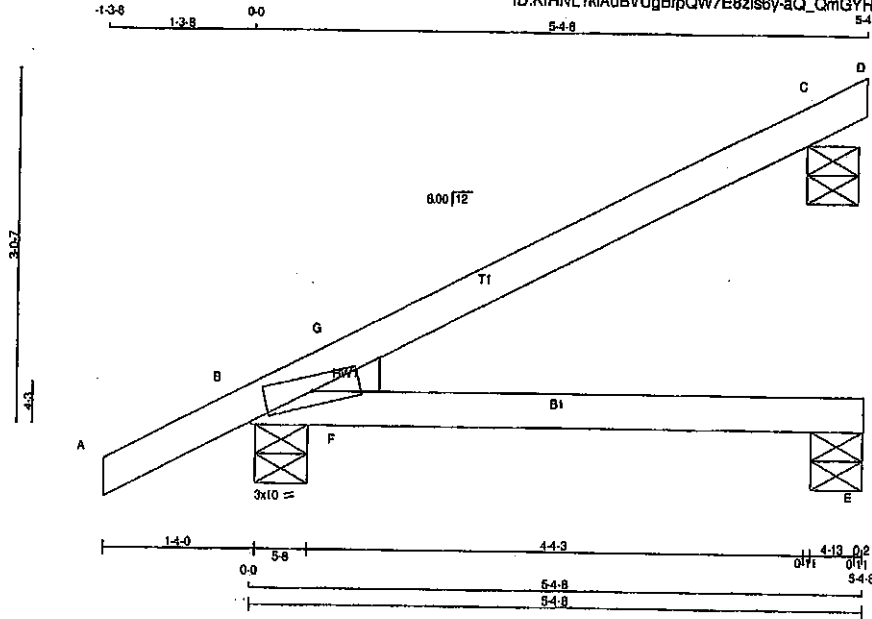

Scale = 1:16.2

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	SPF
A - D	2x4	DRY	No.2			
B - E	2x4	DRY	No.2			

DRY: SEASONED LUMBER.

PLATES (tablets in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMBH1-m	MT20	3.0	10.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	HEEL
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
B	409	0	409	0	0
E	80	0	80	0	0
C	235	0	235	0	0

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS	1ST LCASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW
B	287	201/0
E	59	21/0
C	162	126/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)	MAX. FACTORED MOMENT (FT-LBS)	MAX. FACTORED SHEAR (LBS)	MAX. FACTORED TORSION (FT-LBS)
FR-TO							
A-B	0/26	-91.8	-91.8	0.12 (1)	10.00	101/14	0.00 (1)
B-G	-23/0	-91.8	-91.8	0.08 (4)	6.25		
G-C	0/4	-91.8	-91.8	0.30 (1)	10.00		
C-D	-7/0	-91.8	-91.8	0.01 (1)	10.00		
B-F	0/0	-18.5	-18.5	0.23 (1)	10.00		
F-E	0/0	-18.5	-18.5	0.23 (1)	10.00		

TOTAL WEIGHT = 2 X 15 = 31 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(58% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.08")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/664 (0.10")

CSI: TC=0.30/1.00 (C-G:1), BC=0.23/1.00 (E-F:1),
WB=0.00/1.00 (F-G:1), SSI=0.16/1.00 (B-F:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1667 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.11 (B) (INPUT = 0.90)
JSI METAL = 0.03 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006464

Tamarack Roof Truss, Burlington




Structural component only
DWG# T-2006465

JOB NAME 408165	TRUSS NAME J21	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:44:08 2020 Page 1	

ID:Ovhky48Q0cPQc_Y353NoTWzlcKo-gVWVOPsSF8DOX09DB7P30Uhd04z4hKoMDyxlyezPiZb
1-3-8 1-3-8 0-0 1-9-7 1-9-7 1-10-8 1-9-7 1-10-8

Scale = 1:13.1

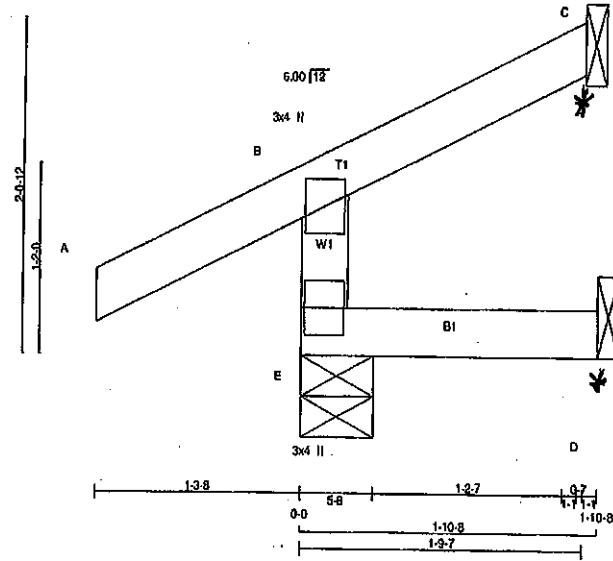

TOTAL WEIGHT = 8 X 7 = 42 lb

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	SPF	SPF
E - B	2x4	DRY	No.2	SPF	SPF
A - C	2x4	DRY	No.2	SPF	SPF
E - D	2x4	DRY	No.2	SPF	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	UP	BRG	INSX	BRG	INSX
E	271	0	271	0	0	5-8	5-8	5-8	5-8
C	45	0	45	0	-23	1-8	1-8	1-8	1-8
D	8	0	17	0	-2	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 160 LBS. FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 160 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS		1ST LCASE		MAX./MIN. COMPONENT REACTIONS		LIVE		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW
E	188	141 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0	0 / 0	0 / 0
C	31	24 / -18	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	7 / 0	0 / 0	0 / 0	0 / 0
D	7	0 / 8	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	LC1 MAX	MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	LC1 MAX
FR-TO		FROM	TO	FR-TO		FROM	TO
E-B	-244 / 0	0.0	0.0	0.04 (5)	7.81		
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00		
B-C	-17 / 0	-91.8	-91.8	0.09 (1)	6.25		
E-D	0 / 0	-18.5	-18.5	0.04 (5)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. GIC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5),
WB=0.00/1.00 (A-C:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)

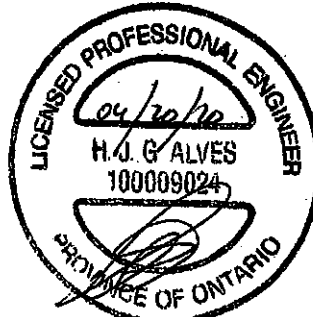


Structural component only
DWG# T-2006477

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408165	J22	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:44:09 2020 Page 1
ID:Ovhiky48Q0cPQc_Y353NoTWzlcKo-9h4tbs50RLE9AkPkxlZhdM8UJeOn2VSchsV4zPzZa

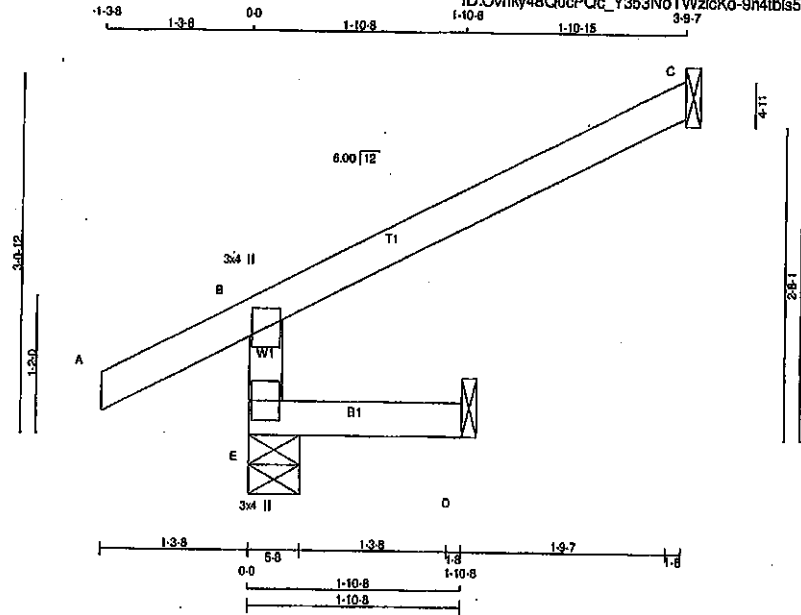

Scale = 1:18.2

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS	2x4	DRY	No.2
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)			
JT TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0 4.0
E	BMV1+p	MT20	3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED		MAXIMUM FACTORED		INPUT		REQD	
	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
JT	361	0	361	0	5.8	5-8	5-8	5-8
E	130	0	130	0	1-8	1-8	1-8	1-8
C	18	0	17	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS		PERM. LIVE	WIND	DEAD	SOIL
	SNOW	LIVE				
JT	250	190 / 0	0 / 0	0 / 0	60 / 0	0 / 0
E	90	73 / 0	0 / 0	0 / 0	17 / 0	0 / 0
C	12	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED	MEMB. FORCE (LBS)	FACTORED		MAX. UNBRACED LENGTH FR-TO	WEBS	MAX. FACTORED	MEMB. FORCE (LBS)	MAX. UNBRACED LENGTH FR-TO
			VERT. LOAD	PLF (LBS)					
FR-TO									
E-B	-342 / 0		0.0	0.0	0.01 (4)	7.81			
A-B	0 / 28		-91.8	-91.8	0.13 (5)	10.00			
B-C	-19 / 0		-91.8	-91.8	0.22 (1)	6.25			
E-D	0 / 0		-18.5	-18.5	0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	8.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPC 2011, TPC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.00")

CSI: TC=0.22/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (W-B:0), SSI=0.15/1.00 (B-C:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1887 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.14 (E) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006478

DWG# T-2006479

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408165	J24	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:44:11 2020 Page 1
ID:Ovhky48Q0cPQc_Y353NaTWzlcKo-53Cd0QuLX3byOUuos7zme6JhelzJuhYowwAzZzzPtZY

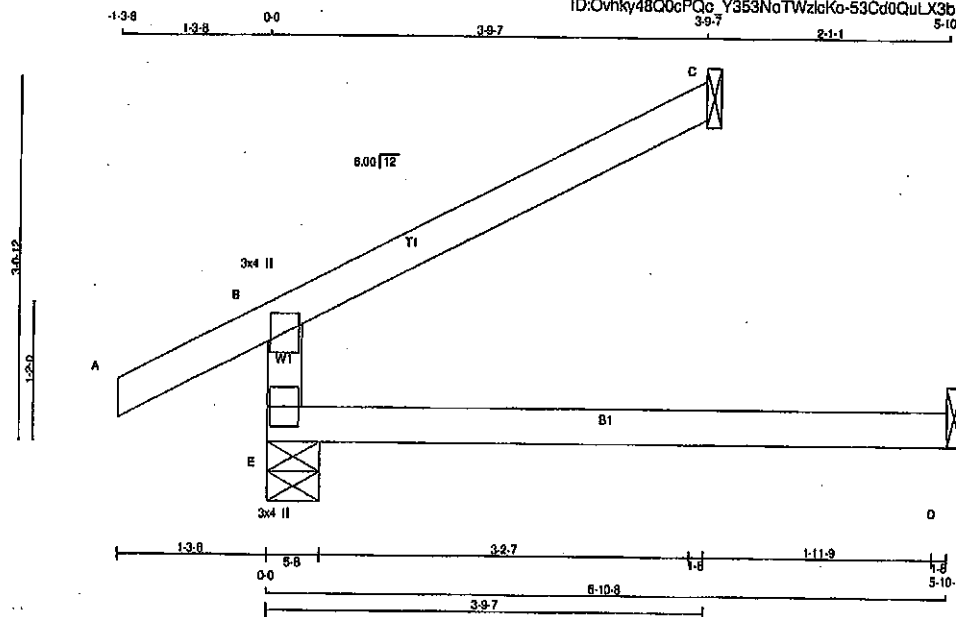

Scale = 1:17.9

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR.
E - B	2x4	DRY	No.2		SPF
A - C	2x4	DRY	No.2		SPF
E - D	2x4	DRY	No.2		SPF
DRY: SEASONED LUMBER					

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	DOWN	UPLIFT	BRG
JT	VERT	HORZ	DOWN	UPLIFT
E	405	0	405	0
C	130	0	130	0
D	45	0	50	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST CASE	MAX/MIN	COMPONENT REACTIONS	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL	
E	288	190 / 0	0 / 0	0 / 0	0 / 0	98 / 0	0 / 0	
C	90	73 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0	
D	38	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		MAX. FACTORED	
MEMB.	FORCE	VERT. LOAD	LC1	MAX	MEMB.	FORCE	MAX
(LBS)	(LBS)	(PLF)	CSI (LC)	UNBRAC	(LBS)	(LBS)	CSI (LC)
FR-TO		FROM	TO	LENGTH	FR-TO		
E-B	-342 / 0	0.0	0.0	0.13 (4)	7.81		
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00		
B-C	-19 / 0	-91.8	-91.8	0.22 (1)	8.25		
E-D	0 / 0	-18.5	-18.5	0.13 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPG 2011, TPG 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL (LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL (LL) = $L/999$ (0.00")
ALLOWABLE DEFL (TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL (TL) = $L/999$ (0.03")

CSK TC=0.22/1.00 (B-C:1), BC=0.13/1.00 (D-E:4),
WB=0.09/1.00 (A-B:0), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	818 354 1687 788 1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.14 (E) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)

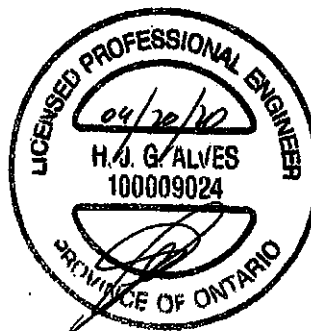

Structural component only
DWG# T-2006480

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408165	J25	11	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. File Apr 17 08:44:12 2020 Page 1
ID:Ovhtky48Q0cPQc_Y353NoTWzlcKo-ZGm0DmvzIMip0aT_QqU?BKmSh1Yd7ox8avW6PzPlZX

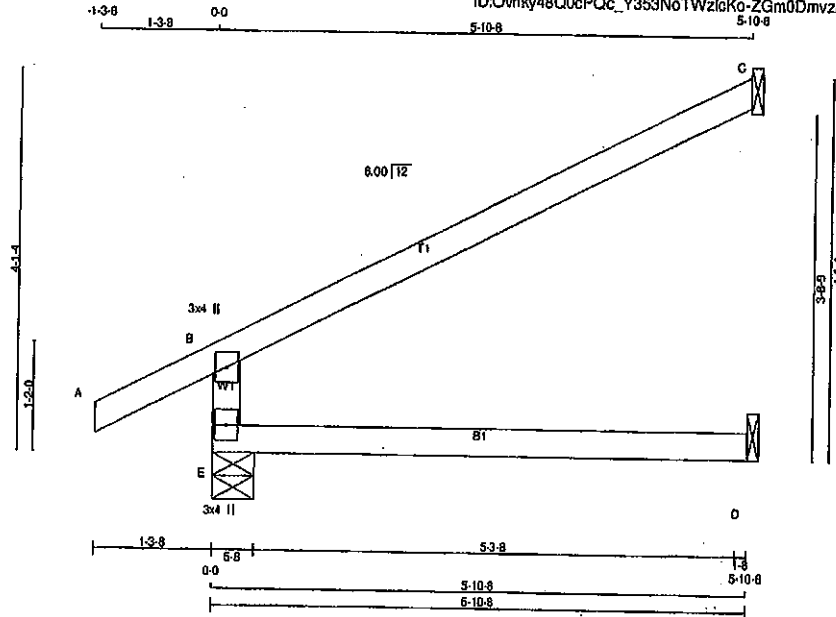

Scale = 1:22.5

TOTAL WEIGHT = 11 X 17 = 185 lb

LUMBER
N. L. G. A. RULES
CHORDS SIZE DRY LUMBER
E - B 2x4 DRY No.2
A - C 2x4 DRY No.2
E - D 2x4 DRY No.2
DRY: SEASONED LUMBER.

DESCR.
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

	FACTORED		MAXIMUM FACTORED		INPUT		REQD	
	GROSS REACTION	GROSS REACTION	GROSS REACTION	GROSS REACTION	BRG	BRG	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX
E	525	0	525	0	0	5-8	5-8	
C	202	0	202	0	0	1-8	1-8	
D	45	0	50	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

	1ST LOUSE		MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
E	369	257 / 0	0 / 0	0 / 0	0 / 0	111 / 0	0 / 0	
C	139	113 / 0	0 / 0	0 / 0	0 / 0	28 / 0	0 / 0	
D	36	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		WEBS		MAX. FACTORED	
	FR-TO	MAX. FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB. FROM TO	MAX. FORCE (LBS)	MAX. CSI (LC)	
E-B	-481 / 0		0.0	0.0	0.13 (4)	7.81		
A-B	0 / 28		-91.8	-91.8	0.12 (1)	10.00		
B-C	-30 / 0		-91.8	-91.8	0.64 (1)	6.25		
E-D	0 / 0		-18.5	-18.5	0.13 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPO 2011, TPO 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.28")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.28")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.03")

CSI: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (A:0), SSI=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (ORV)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1687
	786	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.19 (E) (INPUT = 0.90)
JSI METAL= 0.13 (B) (INPUT = 1.00)

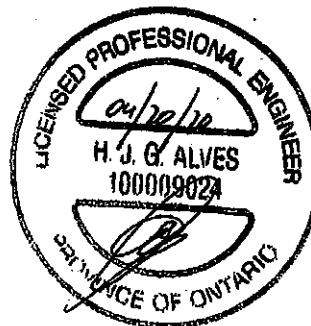

Structural component only
DWG# T-2006481

JOB NAME 408164	TRUSS NAME J26	QUANTITY 9	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:55:30 2020 Page 1
 ID:1ebEM4Ce92xn94Zv7jkFPizmBR3-WDIdmG_7UJIKbQIMVLdkZnqnJND_mHU4qjDN79zMDcR
 Scale = 1:21.2

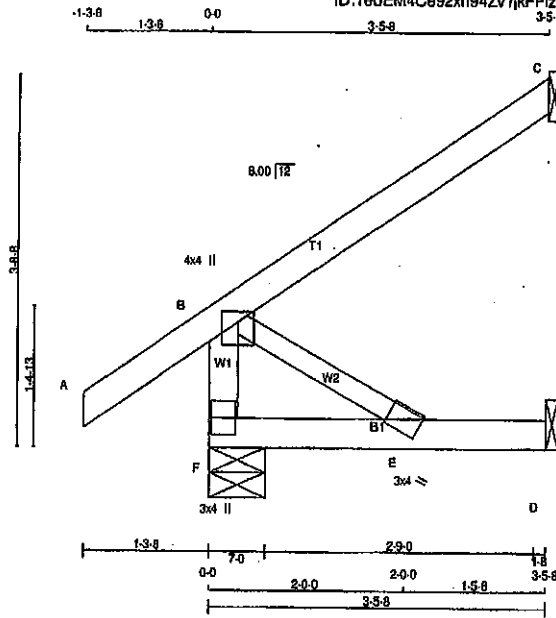

TOTAL WEIGHT = 9 X 14 = 122 lb

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	SPF	
F - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS 2x3 DRY No.2				SPF	
DRY: SEASONED LUMBER.					

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMVW+w	MT20	3.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	COMBINED	SNOW	VERT	DOWN	HORIZ	BRG	IN-SX	BRG	IN-SX
F	317	0	317	0	0	7-0	7-0		
C	159	0	159	0	0	1-8	1-8		
D	32	0	36	0	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) F, D

UNFACTORED REACTIONS		1ST LC CASE		MAX/MIN. COMPONENT REACTIONS		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	VERT	LIVE	PERM. LIVE	WIND	DEAD	SOIL	DEAD	SOIL	DEAD
F	222	159 / 0	0 / 0	0 / 0	0 / 0	0 / 0	63 / 0	0 / 0			
C	109	88 / 0	0 / 0	0 / 0	0 / 0	0 / 0	21 / 0	0 / 0			
D	26	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	28 / 0	0 / 0			

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WIND		DEAD		SOIL	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CS1 (LC)	UNBRAC LENGTH	FR-TO	MEMB.	FORCE (LBS)	CS1 (LC)	UNBRAC LENGTH
F-B	-285 / 0	0.0	0.0	0.03 (1)	7.81	B-E	0 / 0	0.00 (1)	
A-B	0 / 35	-91.8	-91.8	0.14 (5)	10.00				
B-C	0 / 0	-91.8	-91.8	0.18 (1)	10.00				
F-E	0 / 0	-18.5	-18.5	0.08 (4)	10.00				
E-D	0 / 0	-18.5	-18.5	0.08 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
 CALCULATED VERT. DEFL.(LL) = L/889 (0.00")
 ALLOWABLE DEFL.(TL) = L/360 (0.19")
 CALCULATED VERT. DEFL.(TL) = L/889 (0.01")

CS1: TC=0.19/1.00 (B-C:1), BC=0.08/1.00 (E-F:4), WB=0.00/1.00 (B-E:1), SS=0.10/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MT20	618	354	1687
	1687	788	1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.20 (B) (INPUT = 0.80)
 JSI METAL=0.05 (B) (INPUT = 1.00)

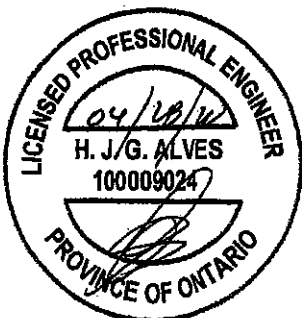

Structural component only
 DWG# T-2007730

JOB NAME 408164	TRUSS NAME J27	QUANTITY 7	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:55:31 2020 Page 1			
		ID:1ebEM4Ce92xm94Zv?kFPizmBR3-_PD?_c?IFdnBCaHY328z5_MuanWoVKjD3NzvXczMDcQ			

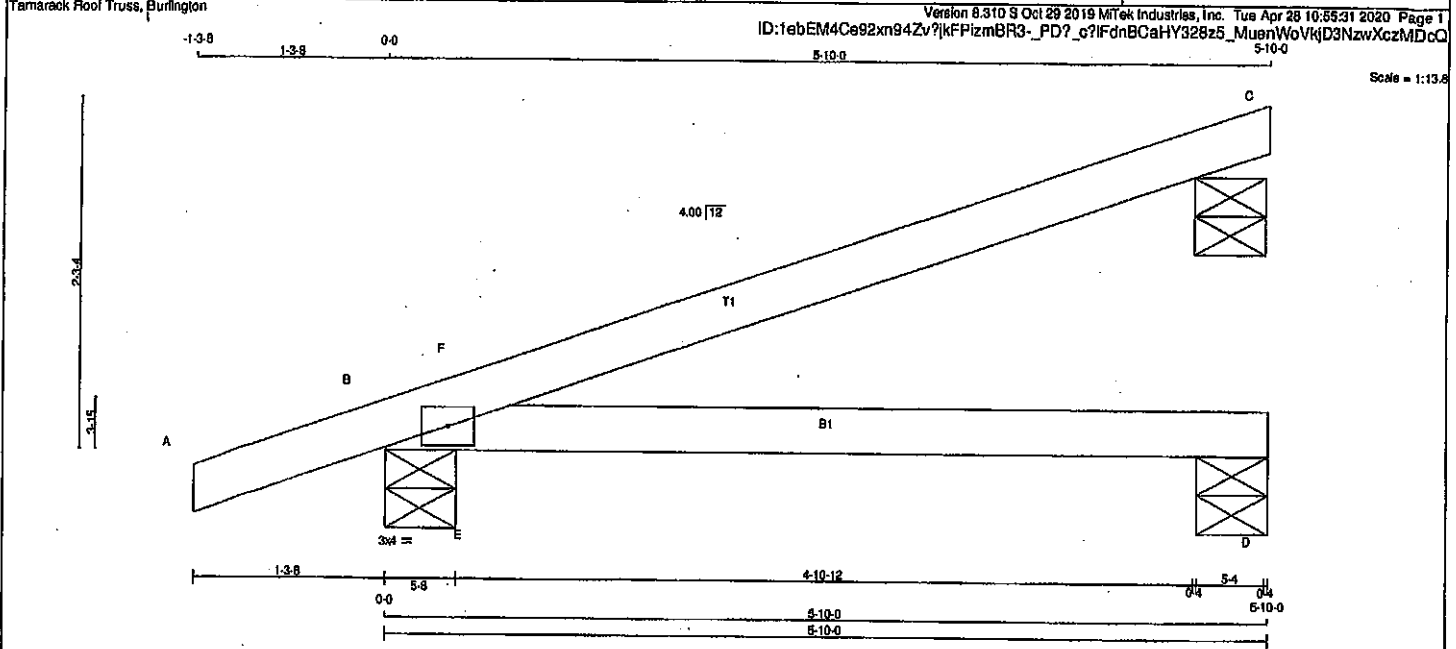

LUMBER	DESCR.
N. L. G. A. RULES	SPF
CHORDS SIZE	SPF
A - C 2x4 DRY	No.2
B - D 2x4 DRY	No.2
DRY: SEASONED LUMBER.	

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE	PLATES			
B TMB1-1	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
C	234	0	234	0	5-8	5-8	5-8	5-8
B	444	0	444	0	5-8	5-8	5-8	5-8
D	88	0	88	0	5-8	5-8	5-8	5-8

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
C	162	128 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0
B	312	218 / 0	0 / 0	0 / 0	0 / 0	94 / 0	0 / 0
D	66	23 / 0	0 / 0	0 / 0	0 / 0	42 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 18	-91.8	-91.8 0.11 (1)	10.00	E-F	-324 / 12	0.00 (1)
B-F	-20 / 18	-91.8	-91.8 0.07 (4)	6.25			
F-C	-2 / 2	-91.8	-91.8 0.41 (1)	10.00			
B-E	0 / 0	-18.5	-18.5 0.28 (1)	10.00			
E-D	0 / 0	-18.5	-18.5 0.28 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/501 (0.14")

CSI: TC=0.41/1.00 (C-F:1), BC=0.28/1.00 (D-E:1),
WB=0.00/1.00 (E-F:1), SSI=0.27/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.29 (B) (INPUT = 0.90)
JSI METAL = 0.08 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007731

JOB NAME 408164	TRUSS NAME J28	QUANTITY 7	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:55:32 2020 Page 1
ID:1ebEM4Ce92xn94Zv7kFPizmBR3-SbnOBy0N0wv2qksdIfCeCv7oBvSEBzNI1IU42zMDcP

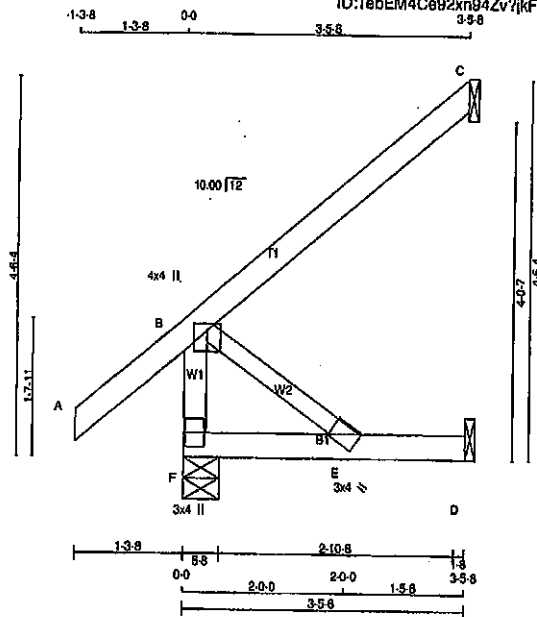

Scale = 1/25.4

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF		
A - C	2x4	DRY	No.2	SPF		
F - D	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
DRY: SEASONED LUMBER.						

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
E	BMV+w	MT20	3.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
F	318	0	318	0	5-8	5-8
C	159	0	159	0	1-8	1-8
D	32	0	38	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOASE COMBINED		MAX/MIN COMPONENT REACTIONS		WIND	DEAD	SOIL
	SNOW	LIVE	PERM.LIVE	WIND			
F	222	159 / 0	0 / 0	0 / 0	63 / 0	0 / 0	0 / 0
C	109	88 / 0	0 / 0	0 / 0	21 / 0	0 / 0	0 / 0
D	28	0 / 0	0 / 0	0 / 0	28 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRAC LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRAC LENGTH FR-TO	MAX. CSI (LC)
F-B	-288 / 0	0.0	0.03 (1)	7.81	0 / 0	0.00 (1)	
A-B	0 / 41	-91.8	-91.8	0.14 (5)	10.00		
B-C	0 / 0	-91.8	-91.8	0.19 (1)	10.00		
F-E	0 / 0	-18.5	-18.5	0.06 (4)	10.00		
E-D	0 / 0	-18.5	-18.5	0.06 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 7 X 14 = 101 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(85% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/380 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSK TC=0.19/1.00 (B-C:1), BC=0.08/1.00 (E-F:4), WB=0.00/1.00 (B-E:1), SB=0.10/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.22 (B) (INPUT = 0.90)
JSI METAL = 0.08 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007732


Structural component only

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408165	J32	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:44:15 2020 Page 1
ID:Ovhky48Q0cPQc_Y353NoTWzlcKo-zrRBsoxrH50i5BZ5z1pyTOhvMqUXNqY8AikzPlZU

Scale = 1:16.4

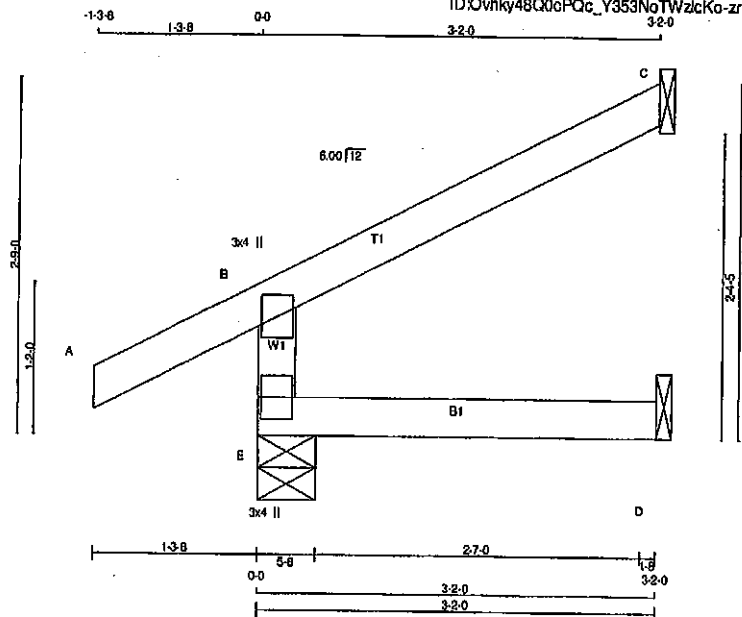

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4 DRY	No.2		
A - C	2x4 DRY	No.2		
E - D	2x4 DRY	No.2		

DRY: SEASONED LUMBER.

DESCR.
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ. UPLIFT		
E	339	0	339	0	5-8	5-8
C	109	0	109	0	1-8	1-8
D	25	0	28	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOASE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
E	237	171 / 0	0 / 0	0 / 0	0 / 0	67 / 0	0 / 0
C	75	61 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0
D	20	0 / 0	0 / 0	0 / 0	0 / 0	20 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (L)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (L)	
FR-TO		FROM	TO	MAX. UNBRAC LENGTH	FR-TO		
E-B	-308 / 0	0.0	0.0	0.03 (4)	7.81		
A-B	0 / 28	-91.8	-91.8	0.13 (5)	10.00		
B-C	-16 / 0	-91.8	-91.8	0.16 (1)	6.25		
E-D	0 / 0	-18.5	-18.5	0.04 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 10 = 31 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.18/1.00 (B-C:1), BC=0.04/1.00 (D-E:4), WB=0.09/1.00 (A-A:0), SSI=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	818 354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.13 (E) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)

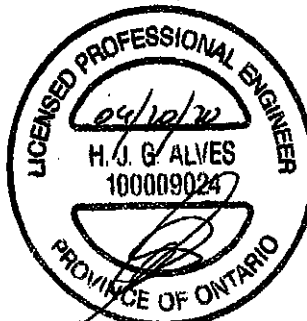

Structural component only
DWG# T-2006483

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408165	J33	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Fri Apr 17 08:44:16 2020 Page 1
ID:Ovhtky48Q0cPQc_Y353NoTWzlcKo-R17W38yUMbDFVfmlgZxLA0YJgdZxnX3CtkFAzPIZT
6-10-0

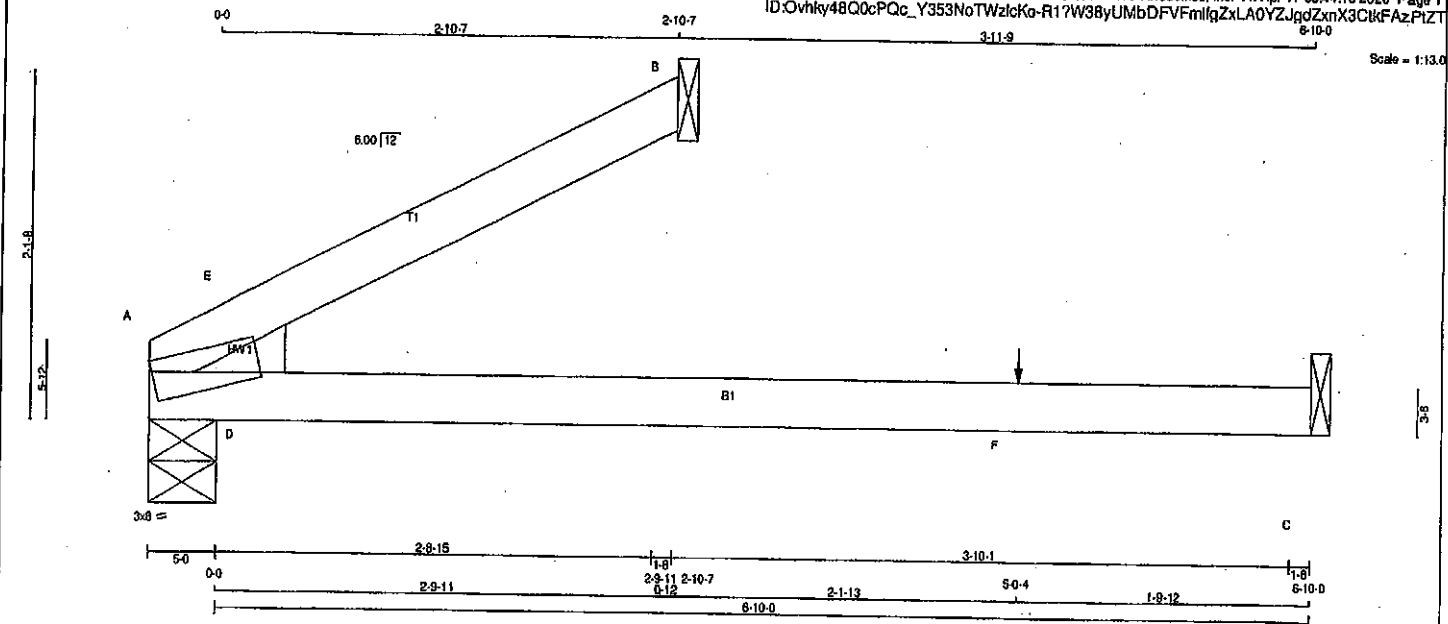

LUMBER	N. L. G. A. RULES	SIZE	LUMBER	DESCR.	SPF
CHORDS	A - B	2x4	DRY	No.2	SPF
CHORDS	A - C	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (tablets in inches)	JT TYPE	PLATES	W	LEN	Y	X
A - B	TBMH1-m	MT20	3.0	8.0	Edge	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING DESIGNER							
BEARINGS							
	FACTORED		MAXIMUM FACTORED		INPUT	REQRD	
	GROSS REACTION		GROSS REACTION		BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	HEEL
A	209	0	209	0	0	5-0	WEDGE
B	166	0	166	0	0	1-8	2x4 L
C	60	0	61	0	0	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS	1ST CASE	MAX/MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE	
A	150	89/0	0/0	0/0	0/0
B	118	75/0	0/0	0/0	0/0
C	47	4/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, B

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED MAX. CS (LC)	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)
FR-TO						FR-TO			
A-E	113/0	-91.8	-91.8	0.18 (4)	6.25	D-E	0/163	0.00 (1)	
E-B	0/20	-91.8	-91.8	0.21 (4)	10.00				
A-D	0/0	-18.5	-18.5	0.11 (4)	10.00				
D-F	0/0	-18.5	-18.5	0.19 (4)	10.00				
F-C	0/0	-18.5	-18.5	0.19 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	5-0-4	1	1	1	1	FRONT	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:		
TOP CH.	LL	= 25.6 PSF
	DL	= 8.0 PSF
BOT CH.	LL	= 0.0 PSF
	DL	= 7.4 PSF
TOTAL LOAD		= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.24")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.24")
CALCULATED VERT. DEFL.(TL) = L/904 (0.10")

CSI: TO=0.21/1.00 (B-E:4), BC=0.19/1.00 (C-D:4), WB=0.00/1.00 (D-E:1), SS=0.15/1.00 (A-E:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE GRIP(DRY) SHEAR	(PSI)	(PL)	(PL)		
	MAX	MIN	MAX	MIN	MAX
MT20	618	354	1667	788	1987

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.07 (A) (INPUT = 0.90)
JSI METAL = 0.01 (A) (INPUT = 1.00)

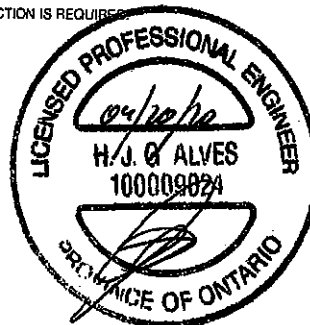


Structural component only
DWG# T-2006484

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408165	J34	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:44:17 2020 Page 1
ID:Ovhky48C0cPQc_Y353NoTWzlcKo-wDZvHUZ67vL67PLyCO4AuNZhk75IO1gisdHndzPIZS

Scale = 1:17.9

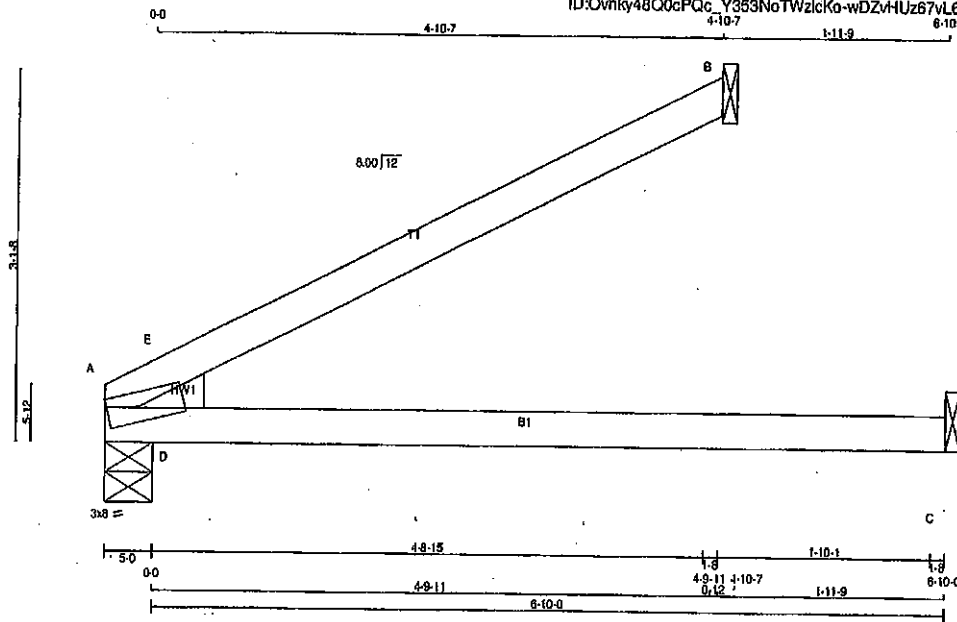

TOTAL WEIGHT = 16 k [M/F]

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR
A - B	2x4	DRY	No.2 SPF
A - C	2x4	DRY	No.2 SPF
DRY: SEASONED LUMBER.			

DRY: SEASONED LUMBER.

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE	PLATES			
A	TBMH1-m	MT20	3.0	8.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG	HEEL WEDGE
	VERT	HORZ	DOWN	HORZ			
A	314	0	314	0	5-0	5-0	2x4 L
B	225	0	225	0	1-8	1-8	
C	80	0	80	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	223	140/0	0/0	0/0	0/0	83/0	0/0
B	157	117/0	0/0	0/0	0/0	40/0	0/0
C	81	13/0	0/0	0/0	0/0	48/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		WEBS		FACTORED	
	MAX. FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX. CS1 (LC)	MEMB. FORCE (LBS)	MAX. CS1 (LC)	MEMB. FORCE (LBS)	MAX. CS1 (LC)
FR-TO								
A-E	-73/0	-91.8	-91.8	0.12 (4)	8.25			
E-B	0/7	-91.8	-91.8	0.38 (1)	10.00	D-E	-143/92	0.00 (1)
A-D	0/0	-18.5	-18.5	0.17 (1)	10.00			
D-C	0/0	-18.5	-18.5	0.23 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.24")
CALCULATED VERT. DEFL.(LL) = U/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.24")
CALCULATED VERT. DEFL.(TL) = U/455 (0.19")

CSI: TC=0.38/1.00 (B-E:1), BC=0.23/1.00 (C-D:1), WB=0.00/1.00 (D-E:1), SSI=0.18/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.15 (A) (INPUT = 0.90)
JSI METAL= 0.02 (A) (INPUT = 1.00)

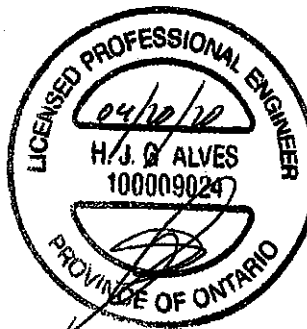

Structural component only
DWG# T-2006485


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408165	J35	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:44:18 2020 Page 1

ID:Ovny48Q0cPQc_Y353NoTWzKCo-QQ7HUqzkuCUzkZw8m5bPQb5wZ6L1pBqXWMqJ3zPlZR

Scale = 1:22.7

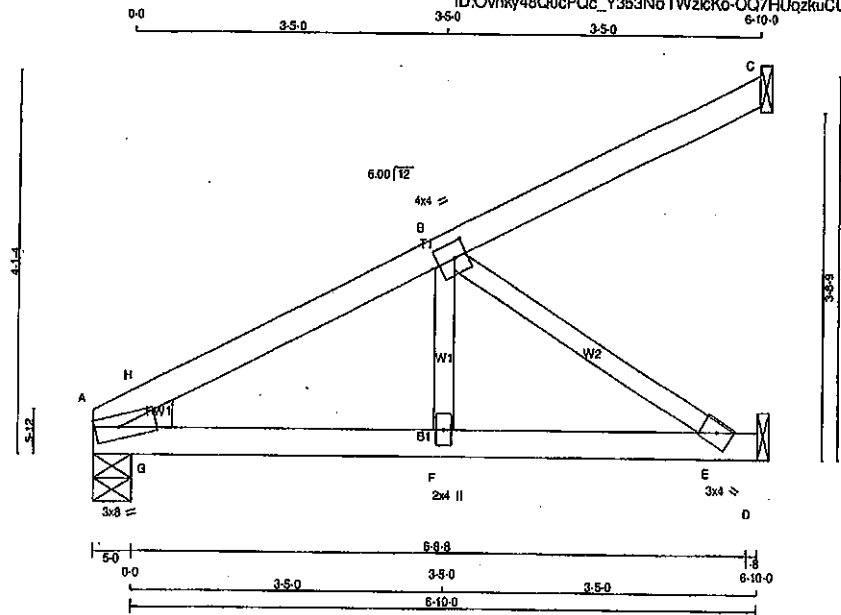

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.	SPF
A - C	2x4	DRY	No.2				
A - D	2x4	DRY	No.2				
ALL WEBS	2x3	DRY	No.2				
DRY: SEASONED LUMBER.							

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
A	TBMH1-m	MT20	3.0	8.0			Edge
B	TMMW-t	MT20	4.0	4.0	2.00	1.75	
E	BMW-w	MT20	3.0	4.0			
F	BMW-w	MT20	2.0	4.0			

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	8RG	8RG
JT	VERT	HORZ	DOWN	HORZ
A	400	0	400	0
C	125	0	125	0
D	275	0	275	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST CASE	MAX/MIN	COMPONENT REACTIONS
JT	SNOW	LIVE
A	283	185 / 0
C	88	89 / 0
D	186	116 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD LC1	MEMB.	FORCE
	(LBS)	(PLF)		(LBS)
FR-TO		FROM	FR-TO	
A-H	-517 / 0	-91.8	F-B	0 / 147
H-B	-461 / 0	-91.8	B-E	-518 / 0
B-C	-14 / 0	-91.8	G-H	-61 / 16
A-G	0 / 424	-18.5		
Q-F	0 / 424	-18.5		
F-E	0 / 424	-18.5		
E-D	0 / 0	-18.5		

TOTAL WEIGHT = 3 X 23 = 68 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.24")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.24")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.12/1.00 (B-H:1), BC=0.24/1.00 (E-F:1),
WB=0.13/1.00 (B-E:1), SS=0.21/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1867 788 1867 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.35 (E) (INPUT = 0.90)
JSI METAL = 0.19 (E) (INPUT = 1.00)



Structural component only
DWG# T-2006486

LUL/LUS/LJS/HUS/HHUS/HGUS

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of a) easier installation, b) higher capacities, c) lower installed cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.

Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:

- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on p. 126.




Double-Shear Nailing Top View




Double-Shear Nailing Side View; Do not bend tab




Double-Shear Nailing Side View (available on some models)
U.S. Patent 5,803,580

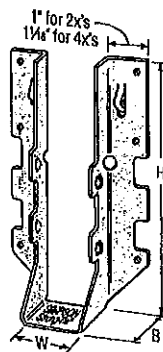


✓ LUS28

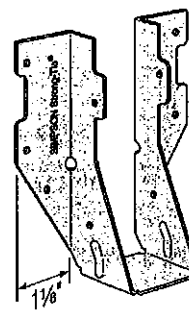


LU26L

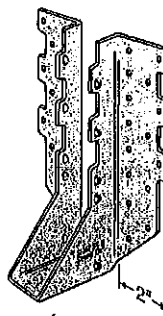


✓ HUS210
(HUS26, HUS28, and HHUS similar)

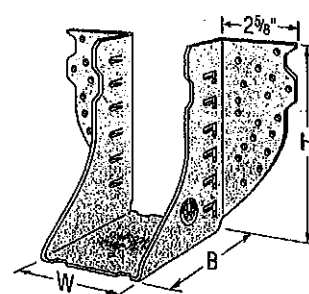

✓ HGUS28-2




✓ HHUS210-2



LJS26DS

Typical HUS26 Installation with Reduced Heel Height
(Truss Designer to provide fastener quantity for connecting multiple members together)

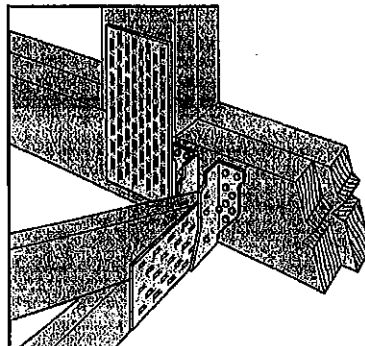

LUL/LUS/LJS/HUS/HHUS/HGUS

HHUS/HGUS

See Hanger Options information on pp. 125–127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
W < 2"	Bevel or square cut	0.62 of table value	0.46 of table value
2" < W < 6"	Bevel cut	0.67 of table value	0.41 of table value
2" < W < 6"	Square cut	0.46 of table value	0.41 of table value
W > 6"	Bevel cut	0.75 of table value	0.41 of table value

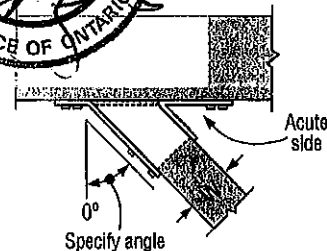

Top View HHUS Hanger Skewed Right
(joist must be bevel cut)
All joist nails installed on the outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (In.)				Fasteners		Factored Resistance			
		W	H	B	d _g ³	Header	Joist	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN	(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN
Single 2x Sizes											
LUS24	18	1⅞	3½	1¼	2¼	(4) 10d	(2) 10d	710 3.16	1625 7.23	645 2.87	1155 5.14
LU24L	22	1⅞	3	1¼	2⅞	(4) 10d	(2) 10d x 1½"	360 1.60	1020 4.54	320 1.42	725 3.22
LU26L	22	1⅞	5	1¼	4¼	(6) 10d	(4) 10d x 1½"	720 3.20	1605 7.14	645 2.87	1140 5.07
LUS26	18	1⅞	4¾	1¼	3¾	(4) 10d	(4) 10d	1420 6.32	2170 9.65	1290 5.74	1630 7.25
HUS26	16	1¾	5¾	3	3⅞	(14) 16d	(6) 16d	2705 11.30	4940 21.97	2065 9.20	3875 17.24
LJS26DS	18	1⅞	5	3½	4¾	(16) 16d	(6) 16d	2065 9.14	4265 18.97	1460 6.49	4115 18.31
HGUS26	12	1¾	5¾	5	4¾	(20) 16d	(8) 16d	2685 11.96	6625 29.51	2685 11.96	5700 25.35
LU28L	20	1⅞	6¾	1¼	5¾	(8) 10d	(6) 10d x 1½"	1140 5.07	2185 9.72	1020 4.54	1550 6.89
LUS28	18	1⅞	8¾	1¼	3¾	(6) 10d	(4) 10d	1420 6.32	2520 11.21	1290 5.74	1790 7.96
HUS28	16	1¾	7⅞	3	6⅞	(22) 16d	(8) 16d	3605 16.04	5365 23.86	2675 11.90	4345 18.33
HGUS28	12	1¾	7⅞	5	6⅞	(36) 16d	(12) 16d	3310 14.74	7675 34.19	3310 14.74	6900 30.73
LU210L	20	1⅞	8	1¼	7¾	(10) 10d	(6) 10d x 1½"	1140 5.07	2495 11.10	1020 4.54	1770 7.87
LUS210	18	1⅞	7⅞	1¼	3¾	(8) 10d	(4) 10d	1420 6.32	2785 12.39	1290 5.74	2210 9.83


1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_g is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _a ³	Header	Joist	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)
								lb.	lb.	lb.	lb.
								kN	kN	kN	kN
Double 2x Sizes											
LUS24-2	18	3 1/8	3 1/8	2	1 1/2	(4) 16d	(2) 16d	835	2020	590	1435
								3.71	8.99	2.62	6.38
SS LUS26-2	18	3 1/8	4 1/8	2	4	(4) 16d	(4) 16d	1720	2595	1545	1920
								7.65	11.54	6.87	8.54
HHUS26-2	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	2850	7335	2065	5205
								12.68	32.63	9.20	23.16
HGUS26-2	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
SS LUS28-2	18	3 1/8	7	2	4	(6) 16d	(4) 16d	1720	3325	1545	2575
								7.65	14.79	6.87	11.46
HHUS28-2	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3765	8940	2675	6345
								16.75	39.77	11.90	28.22
HGUS28-2	12	3 1/8	7 1/8	4	8 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
SS LUS210-2	18	3 1/8	9	2	6	(8) 16d	(6) 16d	2580	4500	2320	3195
								11.48	20.02	10.32	14.21
HHUS210-2	14	3 1/8	9 1/8	3	8	(30) 16d	(10) 16d	4670	9660	4235	7000
								20.77	42.97	18.84	31.14
HGUS210-2	12	3 1/8	9 1/8	4	8 3/8	(46) 16d	(16) 16d	6840	14015	4855	10270
								30.43	62.34	21.60	45.69
Triple 2x Sizes											
HGUS26-3	12	4 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-3	12	4 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d	4670	9670	4235	6865
								20.77	43.02	18.84	30.54
HGUS210-3	12	4 1/8	9 1/8	4	8 3/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.26
Quadruple 2x Sizes											
HGUS26-4	12	6 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-4	12	6 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-4	14	6 1/8	8 1/8	3	7 1/8	(30) 16d	(10) 16d	4670	10155	4235	7210
								20.77	45.17	18.84	32.07
HGUS210-4	12	6 1/8	9 1/8	4	8 3/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.26
HGUS212-4	12	6 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	7640	14995	5425	10645
								33.98	66.70	24.13	47.35
HGUS214-4	12	6 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	51.80
4x Sizes											
LUS46	18	3 1/8	4 1/8	2	3 1/8	(4) 16d	(4) 16d	1720	2595	1545	1920
								7.65	11.54	6.87	8.54
HHUS46	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	2540	7335	2065	5205
								11.30	32.63	9.20	23.16
HGUS46	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
LUS48	18	3 1/8	6 1/8	2	3 1/8	(6) 16d	(4) 16d	1720	3325	1545	2575
								7.65	14.79	6.87	11.46
HHUS48	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3765	8940	2675	6345
								16.75	39.77	11.90	28.22
HGUS48	12	3 1/8	7 1/8	4	8 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
LUS410	18	3 1/8	8 1/8	2	5 1/8	(8) 16d	(6) 16d	2580	4500	2320	3195
								11.48	20.02	10.32	14.21
HGUS410	12	3 1/8	9	4	8 1/8	(46) 16d	(16) 16d	6840	14015	4855	10270
								30.43	62.34	21.60	45.69
HGUS412	12	3 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	7640	14995	5425	10645
								33.98	66.70	24.13	47.35
HGUS414	12	3 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	51.80



Plated Truss Connectors


See footnotes on p. 258.

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

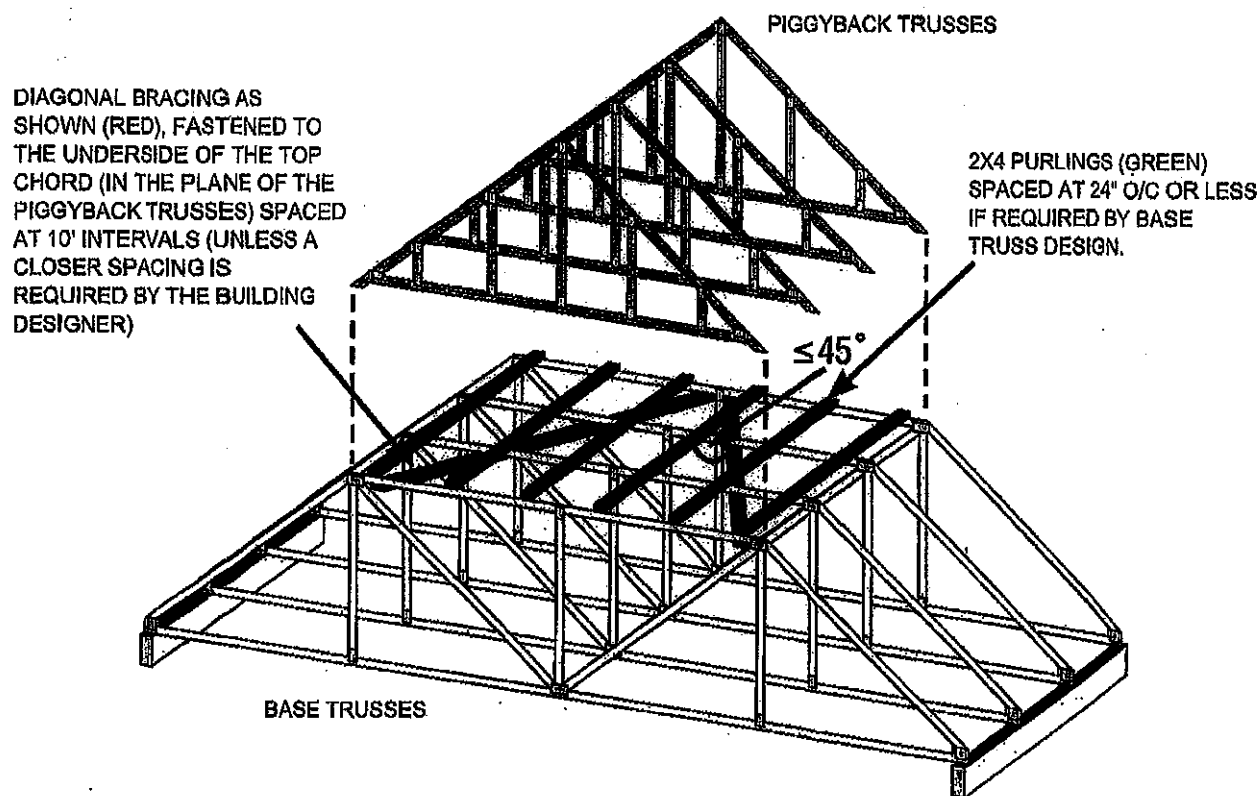

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF); $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to **wind** the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

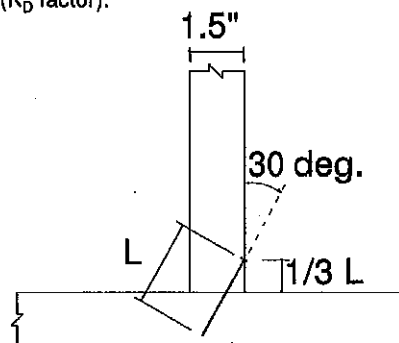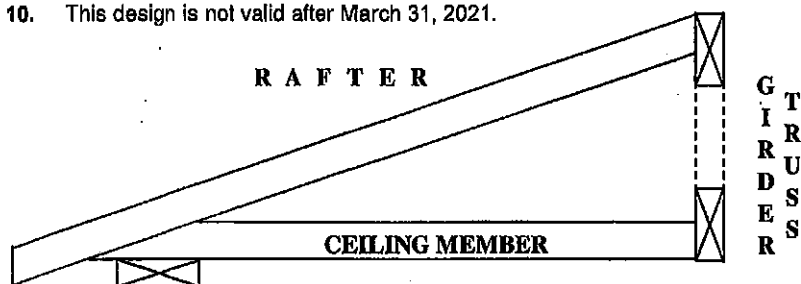

TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019

BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind** or **earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

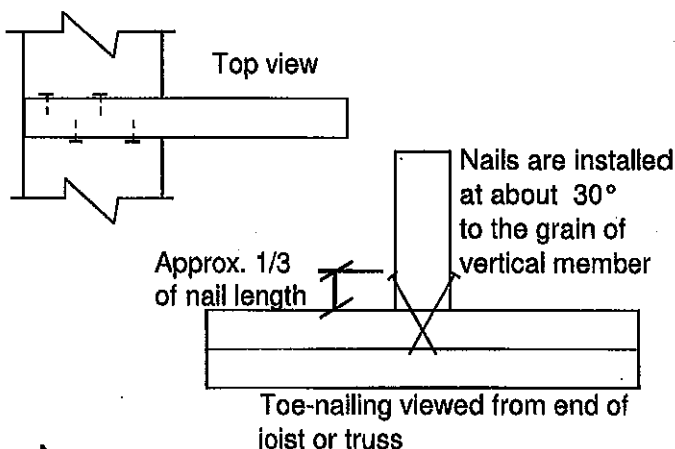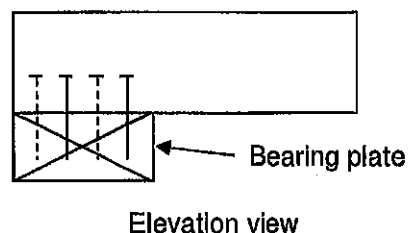

Toe-nailing on 2x4 Bearing Plate

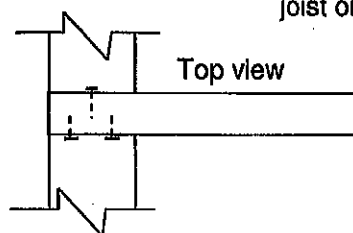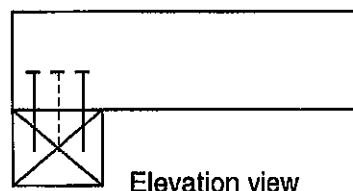


MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7


December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/16\" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
- DSB-89: Design Standard for Bracing.
- BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

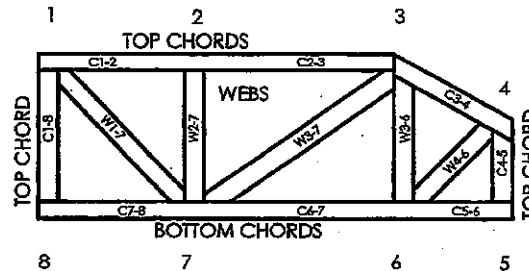

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™


MiTek Engineering Reference Sheet: MII-7473C rev. 10-08



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

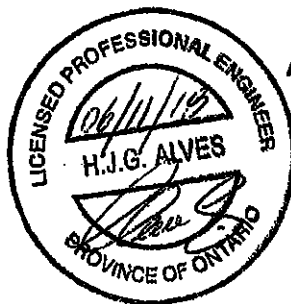

Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1900218

Feb 09, 2018