


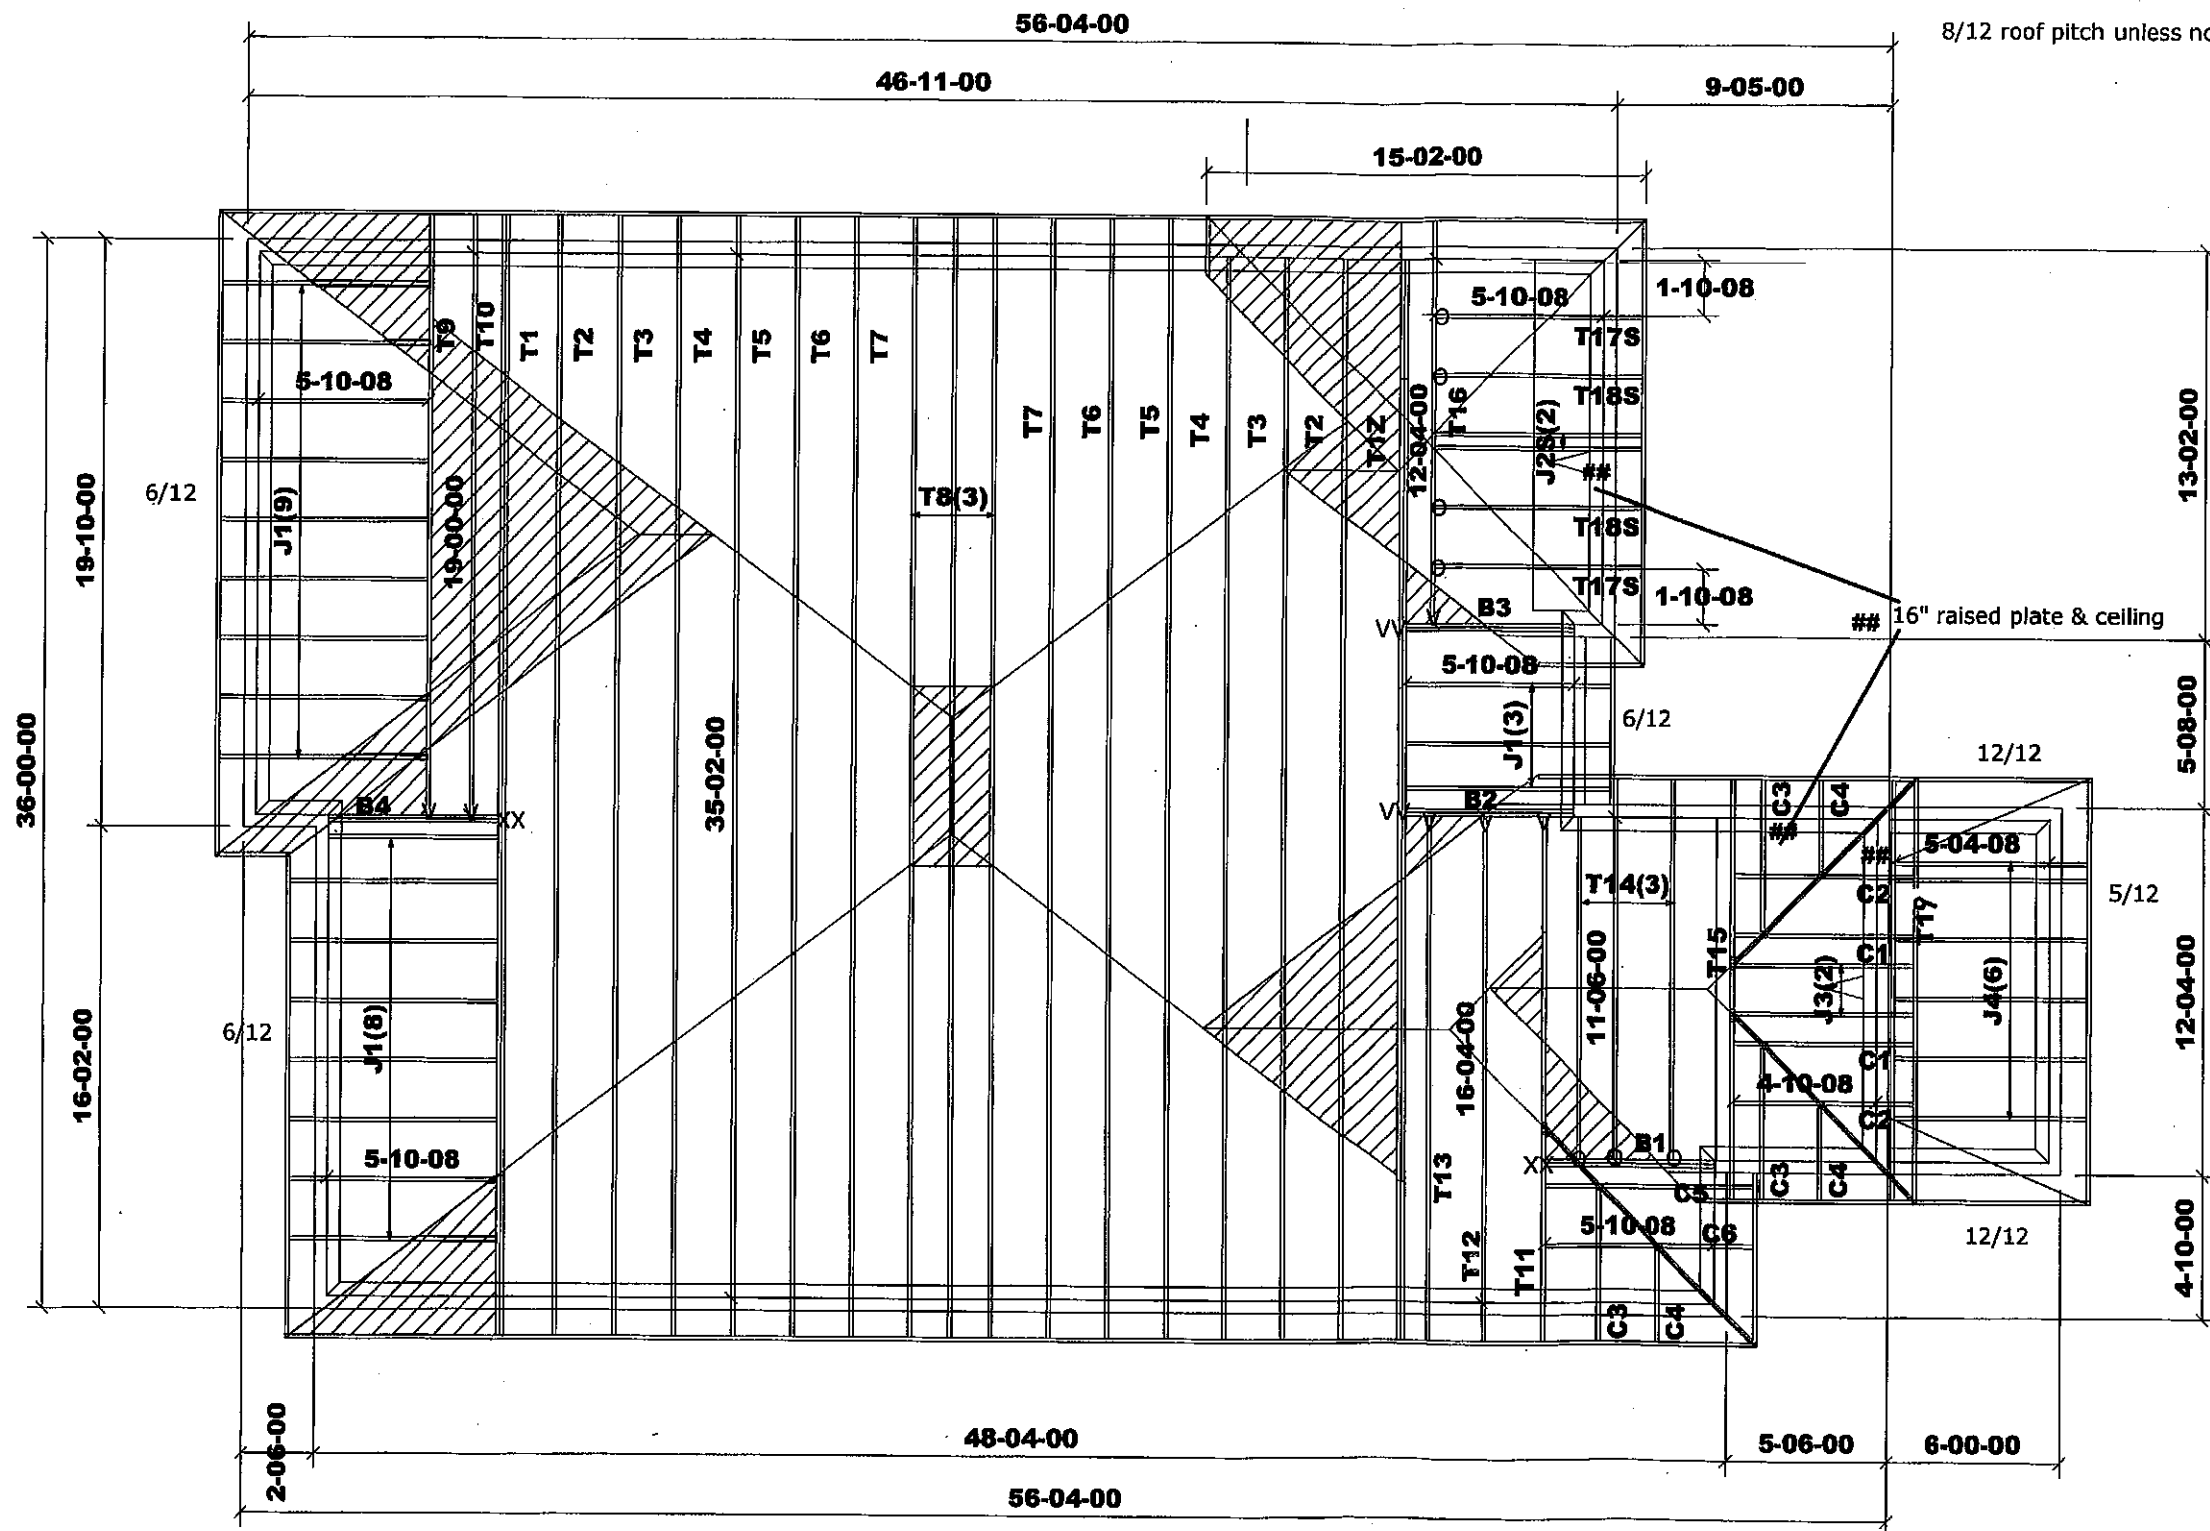

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.


All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)
LUS26-2-(VV)

BEAMS:
B1= B2 = B3=B4=
2 - 2x10 SPF #2

 DENOTES:
CONVENTIONAL
FRAMING

CITY OF HAMILTON
Building Division

Permit No. **20187709**

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

Mitek ver 8.3.1.215
These drawings and/or specifications have been reviewed by

 **APR 23/21**
DATE



Job Track: **51225**
Plan Log: **202428**
Layout ID: **408266**

Builder / Location:
GREEN PARK HOMES / WATERDOWN

Project: **RUSSELL GARDENS PH.3**


Date: 2020-04-27 Sales: **Mario DiCano**

Designer: **JG**

Model / Elevation:
MOUNTAINASH 7/1

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

M-13141

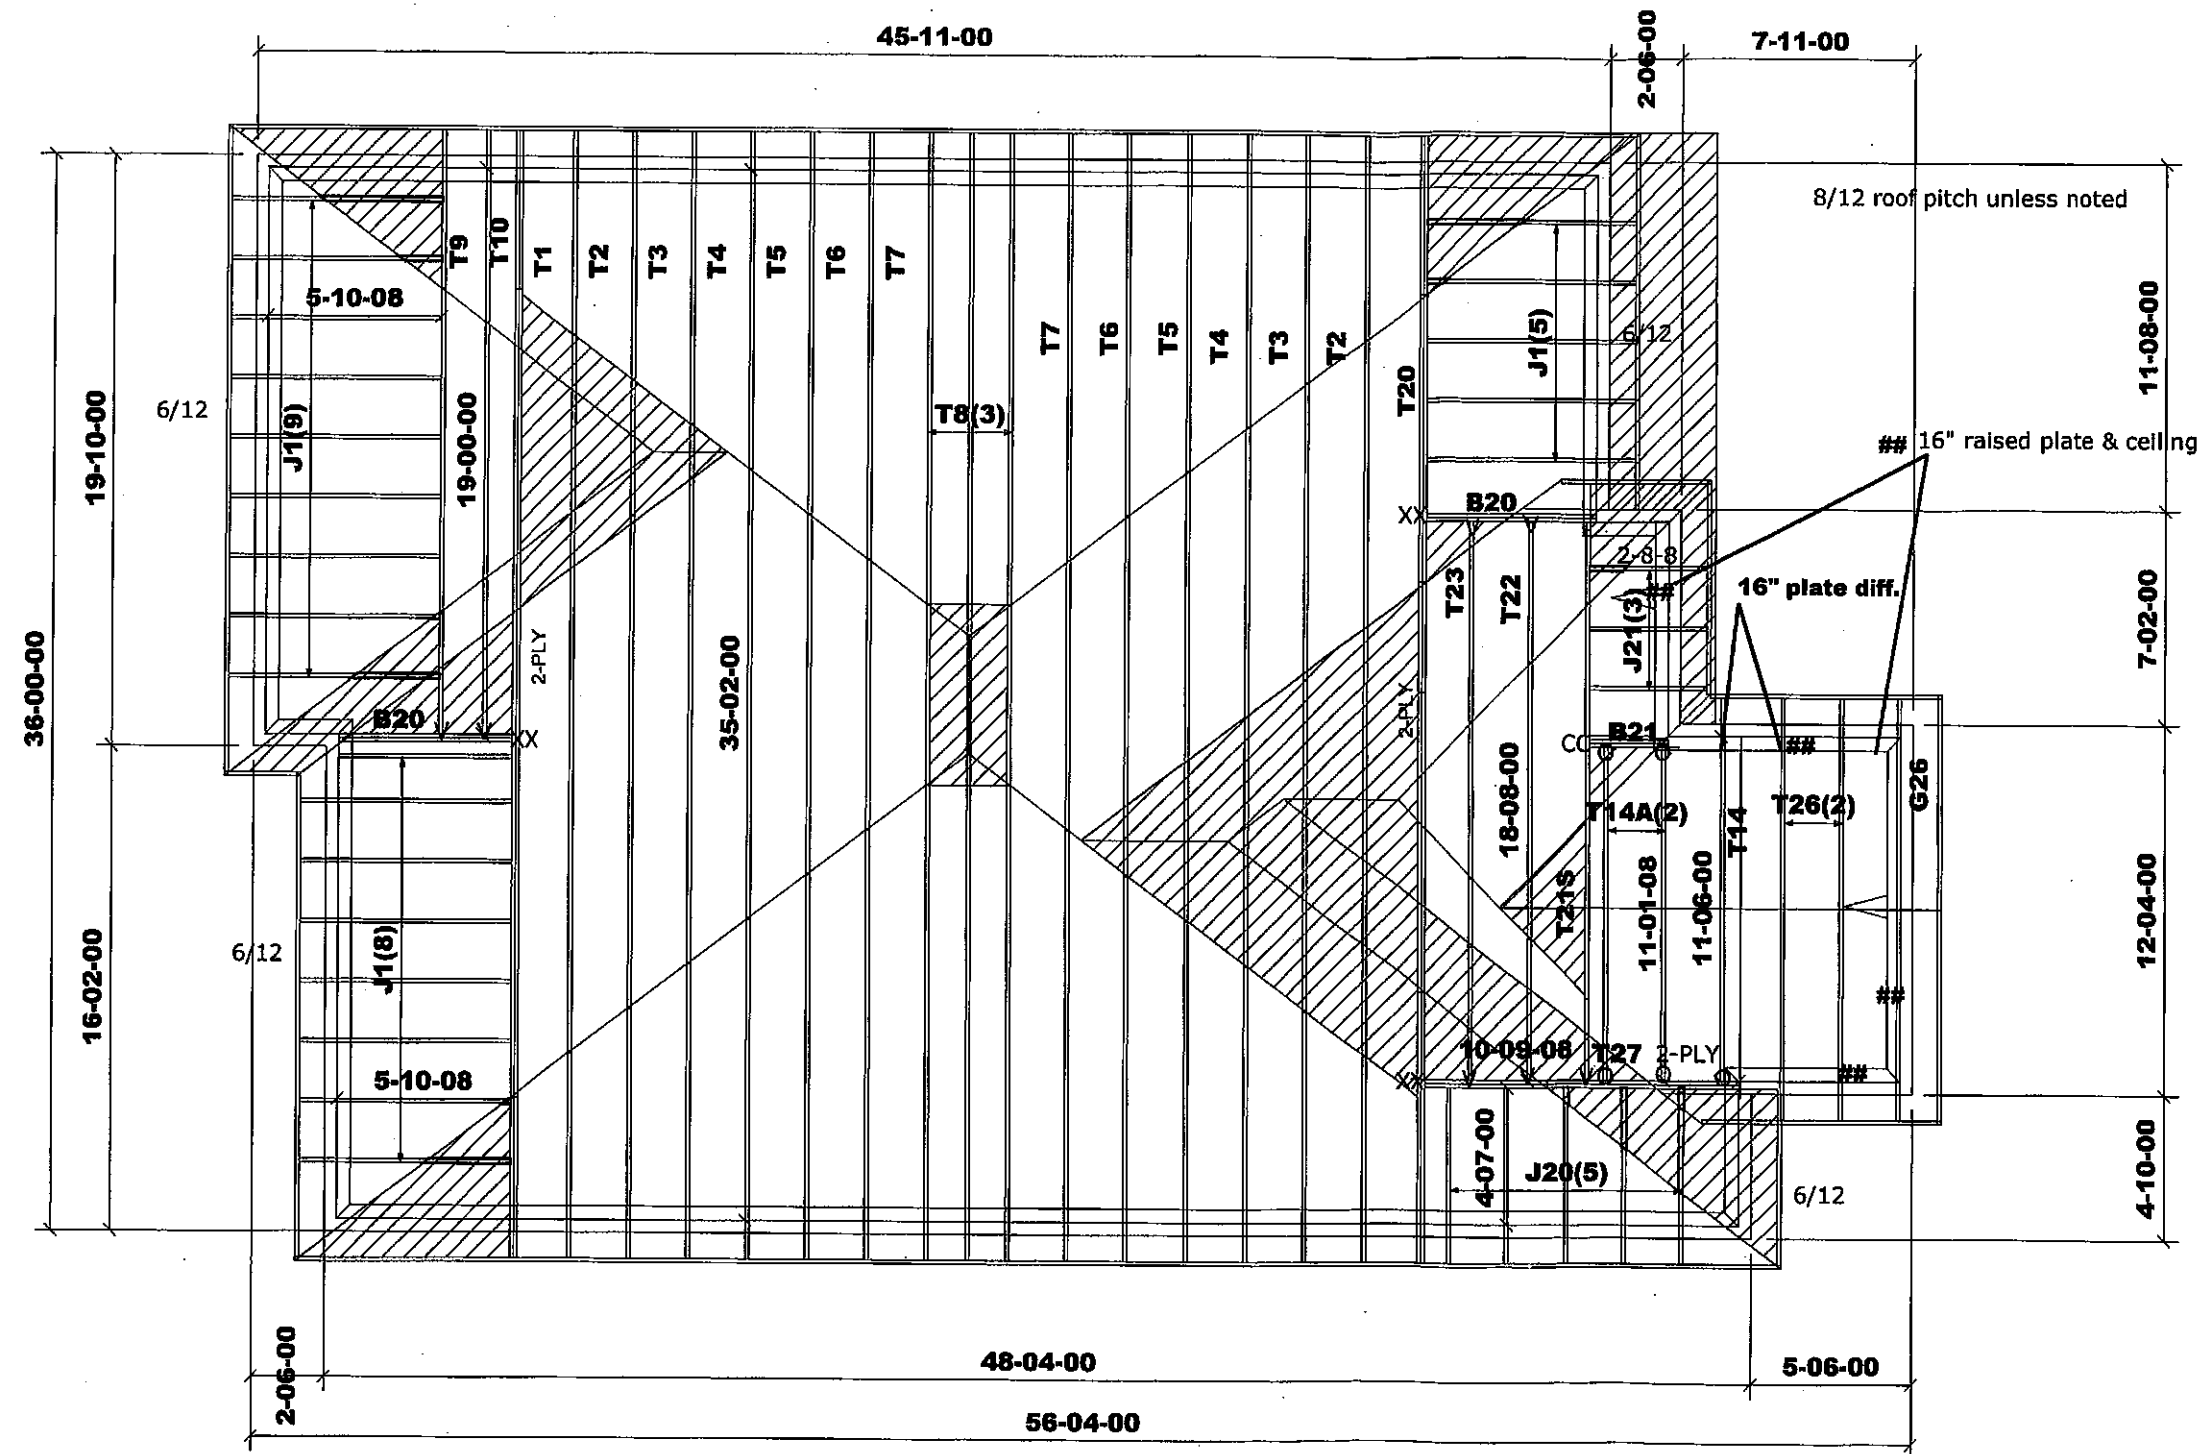

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.


All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)
HUSC26-2(CC)

BEAMS:
B20= 2 - 2x10 SPF #2
B21= 2-2X8

 DENOTES:
CONVENTIONAL FRAMING

Permit No. 20187709

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by
FOR CHIEF BUILDING OFFICIAL
DATE

M 13141




Job Track: 51225
Plan Log: 202428
Layout ID: 408267

Builder / Location: GREEN PARK HOMES / WATERDOWN
Project: RUSSELL GARDENS PH.3
Date: 2020-04-27 Sales: Mario DiCano Designer: JG

Model / Elevation: MOUNTAINASH 7/2

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

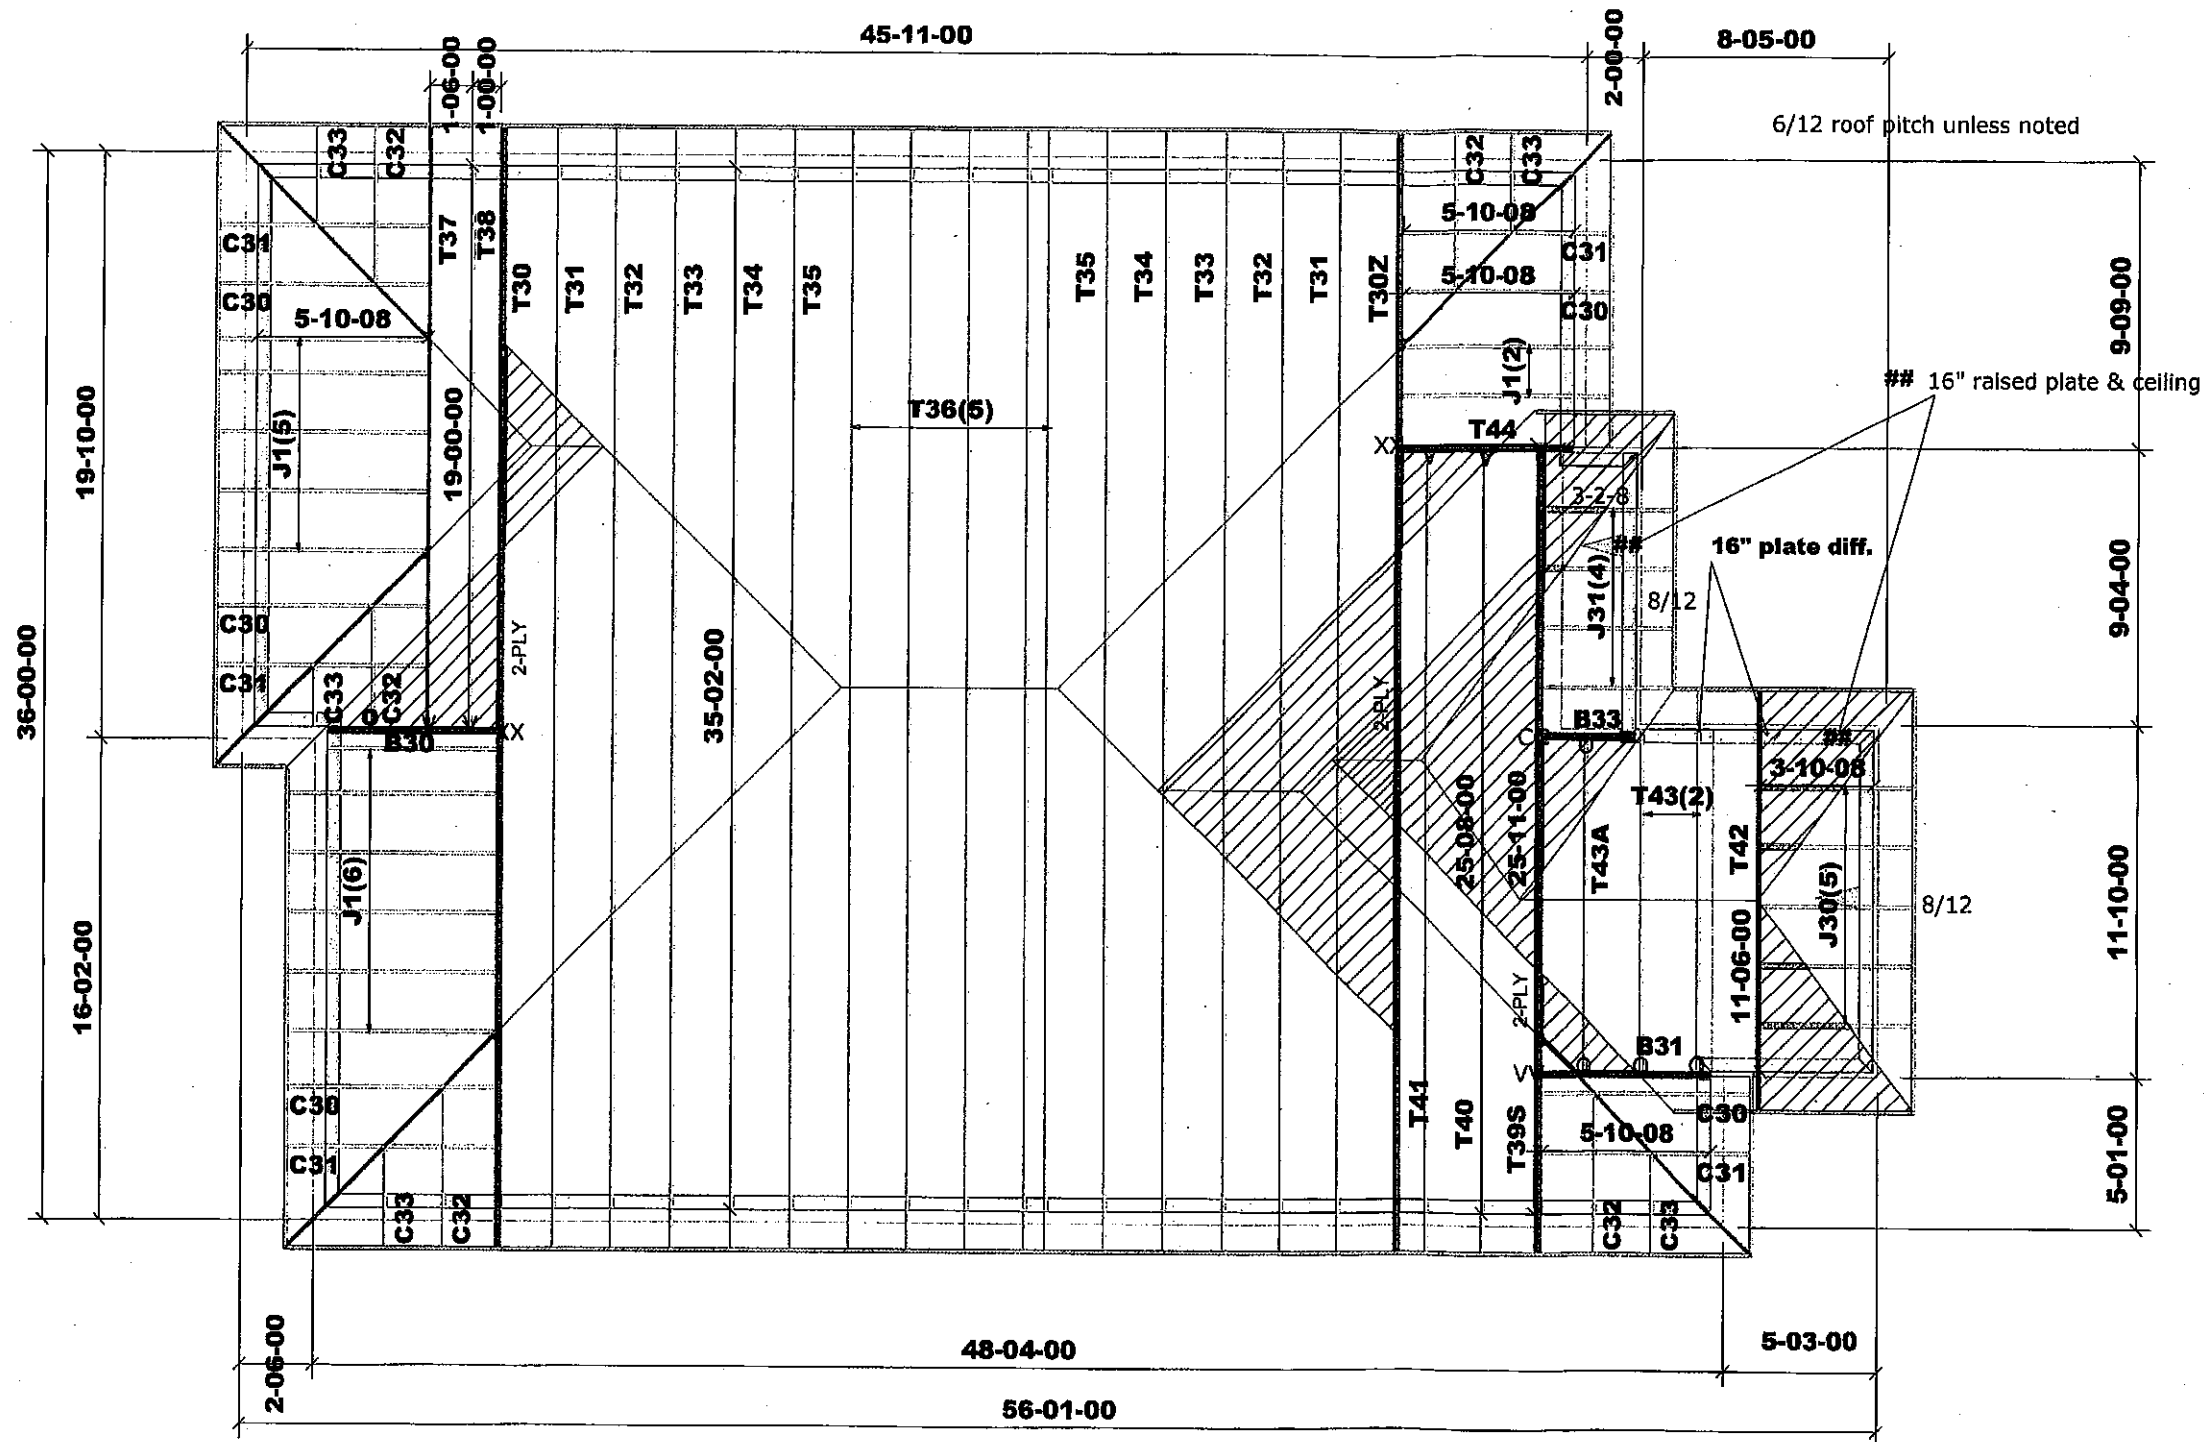

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.


All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)
HUSC26-2-(CC)
LUS26-2 - (VV)

BEAMS:
B30=B31=
2 - 2x10 SPF #2
B33= 2-2X8

 DENOTES:
CONVENTIONAL
FRAMING

CITY OF HAMILTON
Building Division

20187709

Permit No.

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
MICHIGAN BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

 APR 23/21
DATE

M13141



Job Track: 51225
Plan Log: 202428
Layout ID: 408268

Builder / Location:
GREEN PARK HOMES / WATERDOWN

Project: RUSSELL GARDENS PH.3

Date: 2020-04-27 Sales: Mario DiOano

Designer: JG

Model / Elevation:
MOUNTAINASH 7/3

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

FOR CHIEF BUILDING OFFICIAL

DELIVERY SHIPLIST




Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 7
 Lot #:
 Elevation: 1

Job Track: 51225
 PlanLog: 202428
 Layout ID: 408266
 Ref #
 Page: 1 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	8 / 12	35-02-00	4-01-06	2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	361.34 220.00		
	1 2-ply	T12 Hip Girder	8 / 12	35-02-00	4-01-06	2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	361.34 220.00		
	2	T2 Hip	8 / 12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	279.76 177.00		
	2	T3 Hip	8 / 12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	302.77 191.33		
	2	T4 Hip	8 / 12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	309.14 195.67		
	2	T5 Hip	8 / 12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	316.79 196.67		
	2	T6 Hip	8 / 12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	329.26 205.00		
	2	T7 Hip	8 / 12	35-02-00	10-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	343.18 215.33		
	3	T8 Hip	8 / 12	35-02-00	11-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	498.62 310.00		
	1	T9 Hip Girder	8 / 12	19-00-00	4-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	76.42 48.33		
	1	T10 Hip	8 / 12	19-00-00	4-10-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	79.96 49.83		
	1	T11 Hip Girder	8 / 12	16-04-00	5-03-13	2 x 4 2 x 6	1-03-08	1-04-13 2-08-13	83.69 53.67		
	1	T12 Hip	8 / 12	16-04-00	6-07-13	2 x 4	1-03-08	1-04-13 2-08-13	74.68 49.33		
	1	T13 Common	8 / 12	16-04-00	7-06-02	2 x 4	1-03-08	1-04-13 2-08-13	74.68 46.67		

DELIVERY SHIPLIST

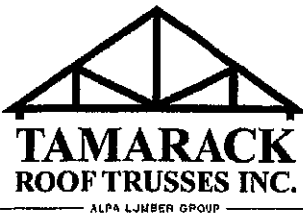

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 7
 Lot #:
 Elevation: 1

Job Track: 51225
 PlanLog: 202428
 Layout ID: 408266
 Ref #
 Page: 2 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	3	T14 Common	8 / 12	11-06-00	6-08-13	2 x 4		2-08-13 2-08-13	146.53 95.00		
	1	T15 Hip Girder	8 / 12	11-06-00	4-07-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	52.37 33.83		
	1	T16 Hip Girder	8 / 12	12-04-00	6-07-13	2 x 4	1-03-08 1-03-08	2-08-13 2-08-13	65.81 44.50		
	2	T17S Jack-Closed	8 / 12	5-10-08	3-11-13	2 x 4	1-03-08	1-04-13 3-11-13	69.98 47.33		
	1	T19 Hip Girder	12 / 12	11-06-00	3-01-07	2 x 4	1-03-08 1-03-08	1-01-15 1-01-15	48.49 32.00		
	2	T18S Jack-Closed	8 / 12	5-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	79.15 53.00		
	20	J1 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	335.89 213.33		
	2	J2S Jack-Open	8 / 12	5-10-08	6-07-13	2 x 4	1-03-08	1-04-13 6-07-13	56.23 36.33		
	2	J3 Jack-Open	8 / 12	4-10-08	4-07-13	2 x 4	1-03-08	1-04-13 4-07-13	33.36 20.67		
	6	J4 Jack-Open	5 / 12	5-04-08	3-01-02	2 x 4	1-03-08	4-01 2-08-15	87.02 56.00		
	2	C1 Jack-Open	8 / 12	3-09-07	3-11-02	2 x 4	1-03-08 1-01-01	1-04-13 3-11-02	30.38 19.33		
	2	C2 Jack-Open	8 / 12	1-09-07	2-07-02	2 x 4	1-03-08 3-01-01	1-04-13 2-07-02	24.65 15.33		
	3	C3 Jack-Open	8 / 12	1-10-08	3-11-02	2 x 4	1-03-08 1-10-15	1-04-13 2-07-13	35.74 23.00		
	3	C4 Jack-Open	8 / 12	1-09-07	2-07-02	2 x 4	1-03-08 1-01	1-04-13 2-07-02	27.51 17.00		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 7
 Lot #:
 Elevation: 1

Job Track: 51225
 Plan Log: 202428
 Layout ID: 408266
 Ref #
 Page: 3 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	C5 Jack-Open	8 /12	3-09-08	3-11-02	2 x 4	1-03-08 2-01-00	1-04-13 3-11-02	16.33 10.33		
	1	C6 Jack-Open	8 /12	1-09-08	2-07-02	2 x 4	1-03-08 4-01-00	1-04-13 2-07-02	13.47 8.33		

TOTAL # TRUSS= 76

TOTAL BFT OF ALL TRUSSES= 2904.14

BFT.

TOTAL WEIGHT OF ALL TRSSES 4614.7 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
2	Hardware	HGUS26-2	
6	Hardware	LJS26DS	
7	Hardware	LUS24	
2	Hardware	LUS26-2	

TOTAL NUMBER OF
ITEMS=


17

 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST					
	Lumber Yard:	TAMARACK LUMBER			Job Track:	51225
Builder:	GREEN PARK HOMES			PlanLog:	202428	
Project:	RUSSELL GARDENS PH.3			Layout ID:	408267	
Location:	WATERDOWN			Ref #		
Model:	MOUNTAINASH 7			Page:	1 of 2	
Lot #:				Date:	04-27-2020	
Elevation:	2			Designer:		
				Sales Rep:	Mario DiCano	

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	8 / 12	35-02-00	4-01-06	2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	361.34 220.00		
	2	T2 Hip	8 / 12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	279.76 177.00		
	2	T3 Hip	8 / 12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	302.77 191.33		
	2	T4 Hip	8 / 12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	308.14 195.67		
	2	T5 Hip	8 / 12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	316.79 196.67		
	2	T6 Hip	8 / 12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	329.26 205.00		
	2	T7 Hip	8 / 12	35-02-00	10-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	343.18 215.33		
	3	T8 Hip	8 / 12	35-02-00	11-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	498.82 310.00		
	1	T9 Hip Girder	8 / 12	19-00-00	4-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	76.42 48.33		
	1	T10 Hip	8 / 12	19-00-00	4-10-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	79.96 49.83		
	1	T14 Common	8 / 12	11-06-00	6-06-13	2 x 4	1-03-08 1-03-08	2-08-13 2-08-13	52.38 33.00		
	2	T14A Common	8 / 12	11-01-08	6-06-13	2 x 4		2-11-13 2-08-13	95.99 62.00		
	1 2-ply	T20 Roof Special Girder	8 / 12	35-02-00	6-06-14	2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	402.66 249.00		
	1	T21S Hip Girder	8 / 12	18-08-00	4-06-08	2 x 4 2 x 6		2-08-13 1-04-13	97.41 62.33		

DELIVERY SHIPLIST

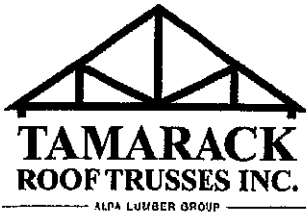

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 7
 Lot #:
 Elevation: 2

Job Track: 51225
 PlanLog: 202428
 Layout ID: 408267
 Ref #
 Page: 2 of 2
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T22 Hip	8 /12	18-08-00	5-10-08	2 x 4		2-08-13 2-08-13	82.54 52.33		
	1	T23 Hip	8 /12	18-08-00	7-02-08	2 x 4		2-08-13 2-08-13	86.37 58.17		
	2	T26 Common	8 /12	11-06-00	5-02-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	95.28 59.67		
	1	G26 GABLE	8 /12	11-06-00	5-02-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	50.14 31.83		
	1 2-ply	T27 Half Hip Girder	6 /12	10-09-08	4-05-08	2 x 4 2 x 6		1-02-00 4-05-08	100.64 65.67		
	22	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	369.48 234.67		
	5	J20 Jack-Open	8 /12	4-07-00	4-05-08	2 x 4	1-03-08	1-04-13 4-05-08	79.74 51.67		
	3	J21 Jack-Open	8 /12	2-08-08	3-02-08	2 x 4	1-03-08	1-04-13 3-02-08	35.98 22.50		

TOTAL # TRUSS= 62

TOTAL BFT OF ALL TRUSSES= 2790


BFT. TOTAL WEIGHT OF ALL TRSSES 4446.06 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
7	Hardware	LJS28DS	
5	Hardware	LUS24	
3	Hardware	HGUS26-2	
1	Hardware	HUSC26-2	

TOTAL NUMBER OF
ITEMS=

16

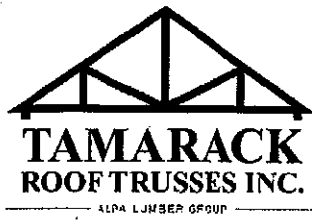

DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 7
 Lot #:
 Elevation: 3

Job Track: 51225
 PlanLog: 202428
 Layout ID: 408268
 Ref #
 Page: 1 of 2
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T30 Hip Girder	6 / 12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	350.24 218.00		
	1 2-ply	T30Z Hip Girder	6 / 12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	350.24 218.00		
	2	T31 Hip	6 / 12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.99 174.00		
	2	T32 Hip	6 / 12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.12 174.67		
	2	T33 Hip	6 / 12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	289.07 179.67		
	2	T34 Hip	6 / 12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	290.73 183.33		
	2	T35 Hip	6 / 12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	301.67 191.33		
	5	T36 Common	6 / 12	35-02-00	9-11-08	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	736.85 453.33		
	1	T37 Hip Girder	6 / 12	19-00-00	4-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	75.77 49.00		
	1	T38 Hip	6 / 12	19-00-00	4-10-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	78.15 49.33		
	1 2-ply	T39S Roof Special Girder	6 / 12	25-11-00	4-10-08	2 x 4 2 x 6	1-03-08	1-02-00 1-00-08	280.76 187.33		
	1	T40 Hip	6 / 12	25-08-00	5-01-04	2 x 4	1-03-08	1-02-00 2-06-00	100.46 83.50		
	1	T41 Hip	6 / 12	25-08-00	6-01-04	2 x 4	1-03-08	1-02-00 2-06-00	109.71 69.67		
	1	T42 Hip Girder	6 / 12	11-06-00	3-11-13	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	44.51 28.00		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 7
 Lot #:
 Elevation: 3

Job Track: 51225
 PlanLog: 202428
 Layout ID: 408268
 Ref #
 Page: 2 of 2
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	T43 Common	6 /12	11-06-00	5-04-08	2 x 4	1-03-08 1-03-08	2-06-00 2-06-00	98.46 65.00		
	1	T43A Common	6 /12	11-01-08	5-04-08	2 x 4		2-08-04 2-06-00	45.02 29.83		
	1 2-ply	T44 Flat Girder	0 /12	5-10-08	1-04-00	2 x 6		1-04-00 1-04-00	53.05 33.67		
	13	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	218.33 138.67		
	5	J30 Jack-Open	8 /12	3-10-08	3-11-13	2 x 4	1-03-08	1-04-13 3-11-13	70.85 45.00		
	4	J31 Jack-Open	8 /12	3-02-08	3-06-08	2 x 4	1-03-08	1-04-13 3-06-08	49.98 33.33		
	5	C30 Jack-Open	6 /12	3-10-15	3-01-08	2 x 4	1-03-08 1-11-09	1-02-00 3-01-08	71.46 43.33		
	5	C31 Jack-Open	6 /12	1-10-15	2-01-08	2 x 4	1-03-08 3-11-09	1-02-00 2-01-08	58.71 36.67		
	5	C32 Jack-Open	6 /12	2-00-00	3-01-08	2 x 4	1-03-08 1-10-15	1-02-00 2-02-00	49.36 30.00		
	5	C33 Jack-Open	6 /12	1-10-15	2-01-08	2 x 4	1-03-08 1-01	1-02-00 2-01-08	36.61 23.33		

TOTAL # TRUSS= 73

TOTAL BFT OF ALL TRUSSES= 2697.99

BFT.

TOTAL WEIGHT OF ALL TRSSES 4293.09 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
2	Hardware	HGUS26-2	
1	Hardware	HUSC26-2	
4	Hardware	LJS26DS	
5	Hardware	LUS24	
1	Hardware	LUS26-2	

TOTAL NUMBER OF
ITEMS=

13

JOB NAME 408266	TRUSS NAME T1	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 26 09:25:58 2020 Page 2
ID:DMCubINVR6TslFoe31v9l_zns1l-pk3o1O_SbmqZ6s1vp7F_qxKekudU5WIMYvw7SXzMEwN

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.50	4.00
C	TTWW+m	MT20	8.0	9.0	Edge	6.50
D	TMWW-t	MT20	5.0	6.0	2.50	2.50
E	TMW+w	MT20	3.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMWW-t	MT20	5.0	6.0	2.50	2.50
H	TTWW+m	MT20	8.0	9.0	Edge	6.50
I	TMVW-p	MT20	5.0	8.0	1.50	4.00
K	BMV1+p	MT20	3.0	6.0		
L	BMWW-t	MT20	5.0	6.0	2.50	2.25
M	BMWW-t	MT20	5.0	8.0	2.50	2.00
N	BS-t	MI18	5.0	12.5		
O	BMWWW-t	MT20	6.0	9.0		
P	BS-t	MI18	5.0	12.5		
Q	BMWW-t	MT20	5.0	8.0	2.50	2.00
R	BMWW-t	MT20	5.0	6.0	2.50	2.25
S	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
V	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	29-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	19-1-8	-2404	-2404	---	FRONT	VERT	TOTAL	---	C1
AA	19-8-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AB	21-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AC	25-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AD	27-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AE	29-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AF	33-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1


CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007685 42

JOB NAME 408266	TRUSS NAME T1Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:25:59 2020 Page 1			

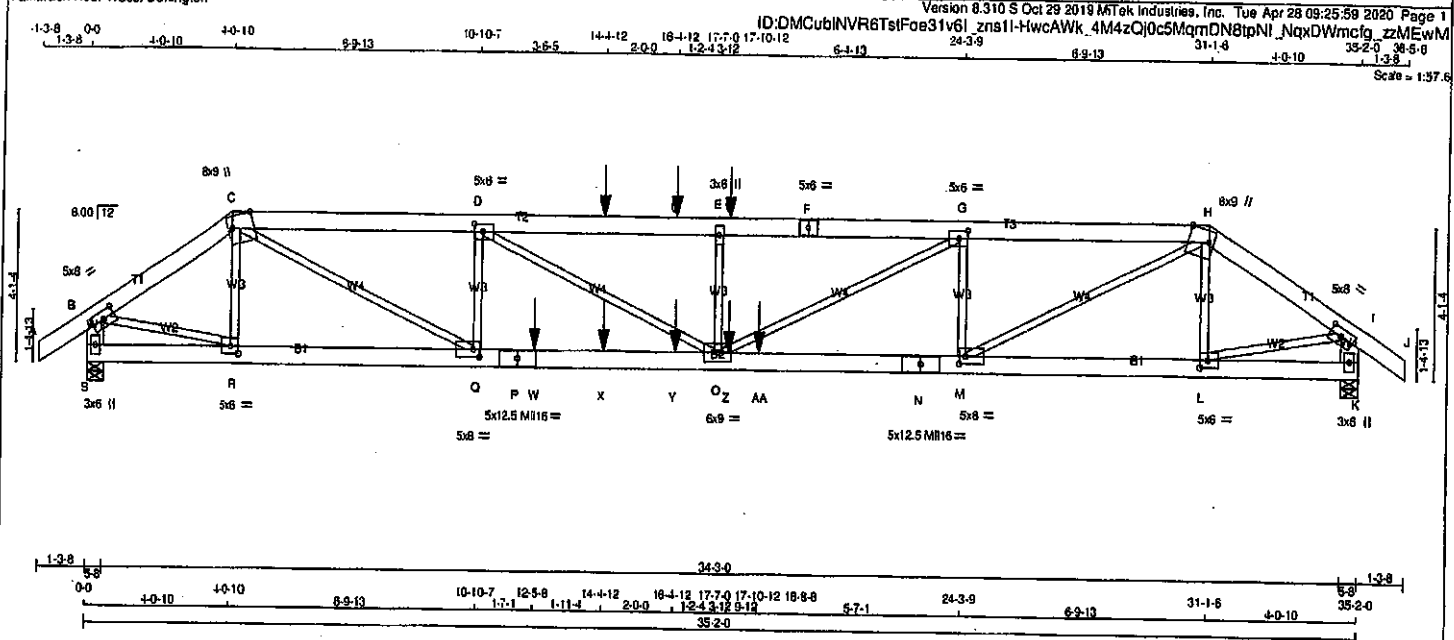

LUMBER			
N.L.G.A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x6 DRY	No.2	SPF
C - F	2x6 DRY	No.2	SPF
F - H	2x6 DRY	No.2	SPF
H - J	2x6 DRY	No.2	SPF
S - B	2x6 DRY	No.2	SPF
K - I	2x6 DRY	No.2	SPF
S - P	2x6 DRY	2100F 1.8E	SPF
P - N	2x6 DRY	2100F 1.8E	SPF
N - K	2x6 DRY	2100F 1.8E	SPF
ALL WEBS EXCEPT	2x3 DRY	No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS SURFACE SPACING (IN) LOAD (PLF)

TOP CHORDS : (0.122"x3") SPIRAL NAILS

A-C 2 12 TOP

C-F 2 12 TOP

F-H 2 12 TOP

H-J 2 12 TOP

S-B 2 12 TOP

K-I 2 12 TOP

BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS

S-P 2 12 TOP

P-N 2 12 SIDE (197.8)

N-K 2 12 TOP

WEBS : (0.122"x3") SPIRAL NAILS

2x3 1 6 TOP

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIROER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

REARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	DOWN	UP	IN-SX
JT 4174 0	4174 0	0 0	5-8 5-8
K 3772 0	3772 0	0 0	5-8 5-8

UNFACTORED REACTIONS			
1ST LCASE	MAX. MIN. COMPONENT REACTIONS		
JT COMBINED	SNOW	LIVE	PERM. LIVE
JT 2943 1982 0	0 0	0 0	0 0
K 2860 1786 0	0 0	0 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.13 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)
FR-TO			
A-B	0 36	-91.8 -91.8 0.04 (1)	10.00
B-C	-5186 0	-91.8 -91.8 0.11 (1)	5.05
C-D	-10498 0	-91.8 -91.8 0.37 (1)	3.57
D-U	-12836 0	-91.8 -91.8 0.53 (1)	3.13
T-U	-12836 0	-91.8 -91.8 0.53 (1)	3.13
E-U	-12836 0	-91.8 -91.8 0.53 (1)	3.13
E-V	-12836 0	-91.8 -91.8 0.45 (1)	3.22
V-F	-12836 0	-91.8 -91.8 0.45 (1)	3.22
F-G	-12836 0	-91.8 -91.8 0.45 (1)	3.22
G-H	-9194 0	-91.8 -91.8 0.32 (1)	3.83
H-I	-4870 0	-91.8 -91.8 0.10 (1)	5.27
I-J	0 36	-91.8 -91.8 0.04 (1)	10.00
S-B	-4140 0	0.0 0.0 0.15 (1)	7.01
K-I	-3759 0	0.0 0.0 0.13 (1)	7.28
WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO			
R-C	-895 0	0.11 (1)	
C-Q	0 7044	0.87 (1)	
Q-D	-1897 0	0.23 (1)	
D-O	0 2433	0.30 (1)	
O-E	-819 0	0.10 (1)	
O-G	0 3917	0.46 (1)	
M-G	-2535 0	0.30 (1)	
M-H	0 6048	0.75 (1)	
L-H	-714 0	0.09 (1)	
B-R	0 4403	0.54 (1)	
L-I	0 3965	0.49 (1)	

FACTORED CONCENTRATED LOADS (LBS)			
JT	LOC.	LC1	MAX.
T	14-4-12	-110	-110
U	16-4-12	-110	-110
V	17-10-12	-110	-110
W	12-5-8	-1654	-1654
X	14-4-12	-26	-26
Y	16-4-12	-26	-26
Z	17-10-12	-26	-26
AA	18-0-8	-1744	-1744

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 181 = 361 lb

DESIGN CRITERIA			
SPECIFIED LOADS:			
TOP CH.	LL = 25.8 PSF		
DL = 6.0 PSF			
BOT. CH.	LL = 0.0 PSF		
DL = 7.4 PSF			
TOTAL LOAD	= 39.0 PSF		
SPACING	= 24.0 IN/C		

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")

CALCULATED VERT. DEFL.(LL) = L/999 (0.31")

ALLOWABLE DEFL.(TL) = L/360 (1.17")

CALCULATED VERT. DEFL.(TL) = L/732 (0.58")

CSI: TC=0.53/1.00 (D-E:1), BC=0.58/1.00 (C-Q:1), WB=0.87/1.00 (C-Q:1), SS=0.55/1.00 (M-O:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP(DRY) SHEAR SECTION			
(PS)	(PL)	(PL)	
MAX MIN MAX MIN MAX MIN			
MT20 816 354 1687 788 1987 1656			
MI16 438 276 2341 1245 4263 1656			

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (INPUT = 0.90)

JSI METAL = 0.83 (INPUT = 1.00)



Structural component only
DWG# T-2007686 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408266	T1Z	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITak Industries, Inc. Tue Apr 28 09:25:59 2020 Page 2
ID:DMCubINVR6TslFog31v6I zns1I-HwCAWk 4M4zQI0c5MqmDN8tpNI NqxDWmcjg zzMEwM

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	8.0	2.50	3.75
C	TTWW+m	MT20	8.0	9.0	Edge	8.50
D	TMWW-l	MT20	5.0	8.0	2.50	2.75
E	TMW+ww	MT20	3.0	8.0		
F	TS-l	MT20	5.0	8.0		
G	TMWW-t	MT20	5.0	8.0	2.50	2.75
H	TTWW+m	MT20	8.0	9.0	Edge	8.50
I	TMWW-l	MT20	5.0	8.0	2.50	3.75
K	BMVl+p	MT20	3.0	8.0		
L	BMWW-l	MT20	5.0	8.0	2.50	2.50
M	BMWW-t	MT20	5.0	8.0	2.50	2.00
N	BS-l	MI16	5.0	12.5		
O	BMWWW-t	MT20	8.0	9.0		
P	BS-l	MI16	5.0	12.5		
Q	BMWWW-t	MT20	5.0	8.0	2.50	2.00
R	BMWW-l	MT20	5.0	8.0	2.50	2.50
S	BMVl+p	MT20	3.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2007686 72

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ORWG NO.
408222	T2	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:00:08 2020 Page 1
ID:DMCubINVR6TsIFoe31v8I zns11-F8H4ajCk5wlmvMOcuAP1x12LCgy5TgYwUz? UzMPId
23-6-9 35-2-0 36-5-8 1-3-8
Scale = 1:57.6

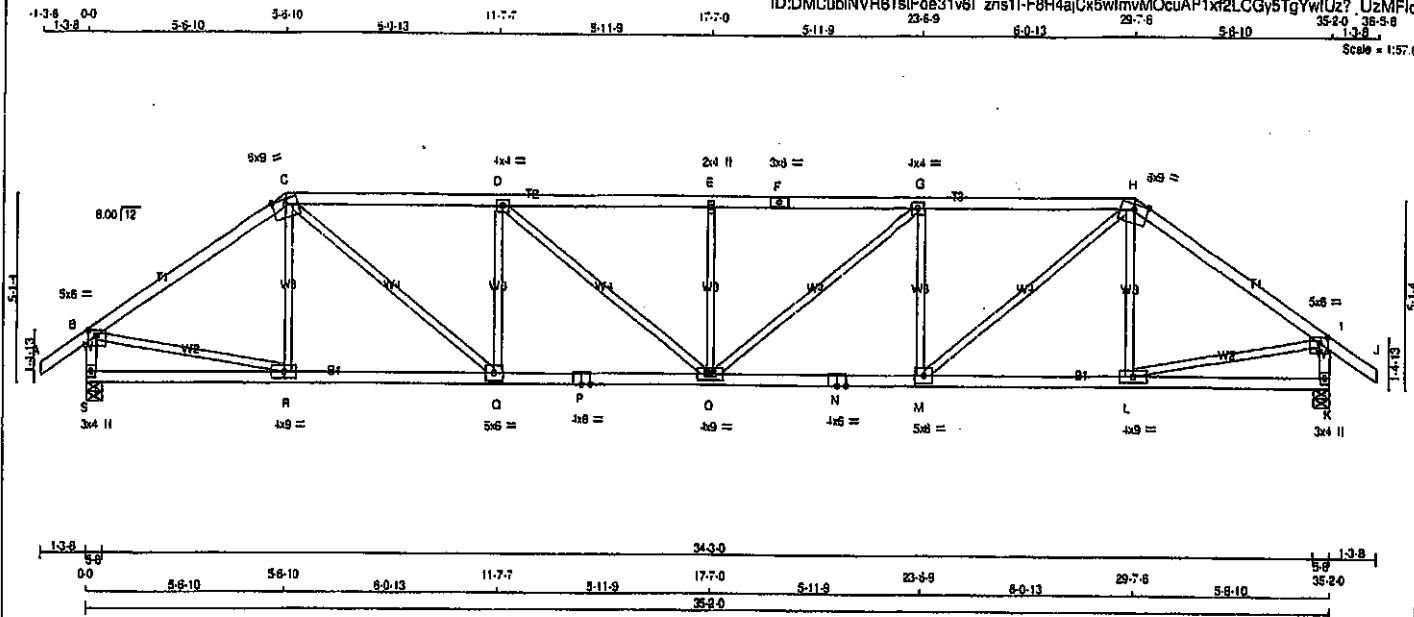

TOTAL WEIGHT = 2 X 140 = 280 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - J	2x4	DRY	No.2	SPF	
J - L	2x4	DRY	No.2	SPF	
L - M	2x4	DRY	No.2	SPF	
M - N	2x4	DRY	No.2	SPF	
N - K	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	6.0	1.75	2.75	
C	TTWW-m	MT20	6.0	9.0	Edge		
D	TMWW-i	MT20	4.0	4.0			
E	TMW-w	MT20	2.0	4.0			
F	TS-i	MT20	3.0	6.0			
G	TMWW-i	MT20	4.0	4.0			
H	TTWW-m	MT20	6.0	9.0	Edge		
I	TMWV-p	MT20	5.0	6.0	1.75	2.75	
K	BMV1-p	MT20	3.0	4.0			
L	BMWW-i	MT20	4.0	9.0			
M	BMWW-i	MT20	5.0	6.0			
N	BS-i	MT20	4.0	6.0			
O	BMWWV-i	MT20	4.0	9.0			
P	BS-i	MT20	4.0	6.0			
Q	BMWW-i	MT20	5.0	6.0			
R	BMWW-i	MT20	4.0	9.0			
S	BMV1-p	MT20	3.0	4.0			

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
S	2065	0	2065	0
K	2065	0	2065	0

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS								
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
S	1458	970	0	0	0	0	488	0	0
K	1458	970	0	0	0	0	488	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.97 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.
		FORCE	(PLF)	(PLF)					FORCE	(PLF)	(PLF)			
FR-TO								FR-TO						
A-B	0	35	-91.8	-91.8	0.12	(1)	10.00	R-C	-243	10	0.09	(1)		
B-C	-2298	0	-91.8	-91.8	0.70	(1)	3.78	C-Q	0	1870	0.38	(1)		
C-D	-3213	0	-91.8	-91.8	0.80	(1)	3.19	Q-D	-928	0	0.38	(1)		
D-E	-3594	0	-91.8	-91.8	0.88	(1)	2.97	D-O	0	490	0.11	(1)		
E-F	-3594	0	-91.8	-91.8	0.88	(1)	2.97	O-E	-505	0	0.19	(1)		
F-G	-3594	0	-91.8	-91.8	0.88	(1)	2.97	O-G	0	490	0.11	(1)		
G-H	-3213	0	-91.8	-91.8	0.80	(1)	3.19	M-G	-928	0	0.38	(1)		
H-I	-2286	0	-91.8	-91.8	0.70	(1)	3.78	M-H	0	1870	0.38	(1)		
I-J	0	35	-91.8	-91.8	0.12	(1)	10.00	L-H	-243	10	0.09	(1)		
S-B	-2023	0	0.0	0.0	0.21	(1)	5.94	B-R	0	1943	0.44	(1)		
K-I	-2023	0	0.0	0.0	0.21	(1)	5.94	L-I	0	1943	0.44	(1)		
S-R	0	0	-18.5	-18.5	0.15	(4)	10.00							
R-Q	0	1903	-18.5	-18.5	0.39	(1)	10.00							
Q-P	0	3213	-18.5	-18.5	0.58	(1)	10.00							
P-O	0	3213	-18.5	-18.5	0.58	(1)	10.00							
O-N	0	3213	-18.5	-18.5	0.58	(1)	10.00							
N-M	0	3213	-18.5	-18.5	0.58	(1)	10.00							
M-L	0	1903	-18.5	-18.5	0.39	(1)	10.00							
L-K	0	0	-18.5	-18.5	0.15	(4)	10.00							

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOY CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

ISS % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/989 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/989 (0.39")

CS: TC=0.86-1.00 (D-E:1), SC=0.58-1.00 (M-O:1),
WB=0.44-1.00 (I-L:1), SS=0.26-1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 (S BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PL) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.87 (I) (INPUT = 0.90)
JSI METAL = 0.74 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007604

JOB NAME 408222	TRUSS NAME T3	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 5 Oct 2019 MTek Industries, Inc. Tue Apr 28 08:00:06 2020 Page 1	
ID:DMCubINVR6TstFoe31v61_zns11-F8H4ajCx6wlmwMOcuAP1xf2QrG_VTXHw/Uz? UzMFid				35-2-0 35-5-8 1-3-8	
1-3-8 0-0 3-7-9 3-7-9 3-5-1 7-0-10 5-3-13 12-4-7 5-2-9 17-7-0 5-2-9 22-9-9 5-3-13 28-1-6 3-5-1 31-6-7 37-9 1-3-8				Scale = 1:57.6	

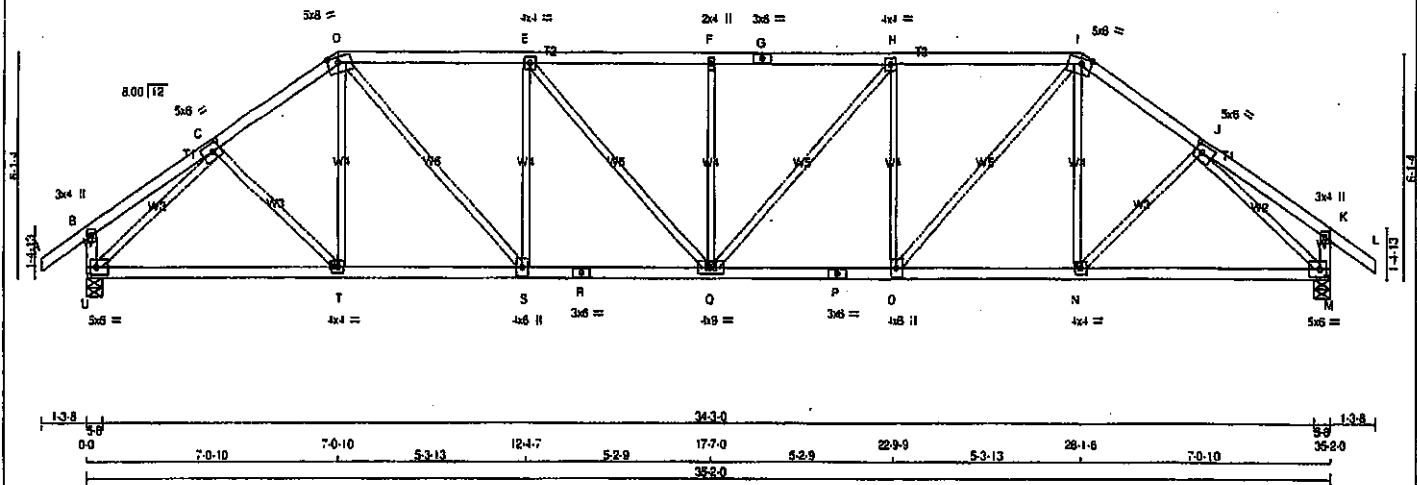

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - G	2x4	DRY No.2	SPF
G - I	2x4	DRY No.2	SPF
I - L	2x4	DRY No.2	SPF
U - B	2x4	DRY No.2	SPF
M - K	2x4	DRY No.2	SPF
U - R	2x4	DRY No.2	SPF
R - P	2x4	DRY No.2	SPF
P - M	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
C	TMWV-I	MT20	5.0	6.0	2.50 2.50
D	TTWV-m	MT20	5.0	8.0	1.75 3.50
E	TMWV-I	MT20	4.0	4.0	
F	TMWV-w	MT20	2.0	4.0	
G	TS-I	MT20	3.0	6.0	
H	TMWV-I	MT20	4.0	4.0	
I	TTWV-m	MT20	5.0	8.0	1.75 3.50
J	TMWV-I	MT20	5.0	6.0	2.50 2.50
K	TMV+p	MT20	3.0	4.0	
M	BMWV-I	MT20	5.0	6.0	2.50 2.25
N	BMWV-I	MT20	4.0	4.0	
O	BMWV-I	MT20	4.0	6.0	
P	BS-I	MT20	3.0	6.0	
Q	BMWVW-I	MT20	4.0	9.0	
R	BS-I	MT20	3.0	6.0	
S	BMWV-I	MT20	4.0	6.0	
T	BMWV-I	MT20	4.0	4.0	
U	BMWV-I	MT20	5.0	6.0	2.50 2.25

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORIZ	UPLIFT
U	2065	0	2065	0
M	2065	0	2065	0

UNFACTORED REACTIONS

	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	1458	970	0	0	0	488	0
M	1458	970	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.53 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO		FR-TO			
A-B	0 35	-91.8 -91.8 0.12 (1)	10.00	C-T	0 135	0.03 (4)	
B-C	0 18	-91.8 -91.8 0.16 (1)	10.00	T-D	0 90	0.03 (4)	
C-D	-2305 0	-91.8 -91.8 0.23 (1)	4.31	D-G	0 1218	0.27 (1)	
D-E	-2723 0	-91.8 -91.8 0.54 (1)	3.69	E-H	-914 0	0.46 (1)	
E-F	-2986 0	-91.8 -91.8 0.56 (1)	3.53	F-I	0 383	0.08 (1)	
F-G	-2986 0	-91.8 -91.8 0.56 (1)	3.53	G-H	-440 0	0.26 (1)	
G-H	-2986 0	-91.8 -91.8 0.56 (1)	3.53	H-I	0 383	0.08 (1)	
H-I	-2723 0	-91.8 -91.8 0.54 (1)	3.69	I-J	-914 0	0.46 (1)	
I-J	-2305 0	-91.8 -91.8 0.23 (1)	4.31	J-K	0 1218	0.27 (1)	
J-K	0 18	-91.8 -91.8 0.16 (1)	10.00	K-L	0 90	0.03 (4)	
K-L	0 35	-91.8 -91.8 0.12 (1)	10.00	L-M	0 135	0.03 (4)	
U-B	-255 0	0.0 0.0 0.03 (1)	7.81	U-C	-2514 0	0.97 (1)	
M-K	-255 0	0.0 0.0 0.03 (1)	7.81	J-M	-2514 0	0.97 (1)	
U-T	0 1801	-18.5 -18.5 0.40 (1)	10.00				
T-S	0 1900	-18.5 -18.5 0.41 (1)	10.00				
S-R	0 2723	-18.5 -18.5 0.49 (1)	10.00				
R-O	0 2723	-18.5 -18.5 0.49 (1)	10.00				
O-P	0 2723	-18.5 -18.5 0.49 (1)	10.00				
P-O	0 2723	-18.5 -18.5 0.49 (1)	10.00				
O-N	0 1800	-18.5 -18.5 0.41 (1)	10.00				
N-M	0 1801	-18.5 -18.5 0.40 (1)	10.00				

TOTAL WEIGHT = 2 X 151 = 303 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN PLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2015 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1/17")
CALCULATED VERT. DEFL. (LL) = L/999 (0.16")
ALLOWABLE DEFL. (TL) = L/360 (1/17")
CALCULATED VERT. DEFL. (TL) = L/999 (0.29")

CSI: TC=0.56 (1.00 (E-F:1), BC=0.49 (1.00 (C-D:1), WS=0.97 (1.00 (J-M:1), SS=0.23 (1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION
(PS) (PL) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.80 (M) (INPUT = 0.90)
JSI METAL = 0.84 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007605


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T4	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:07 2020 Page 1

ID:DMCubINVR6TslFoe31v6f_zns1H-LrSn2CZsQdXWzpsuWGTsbZlqK2CST4u8IYVWzMFic

1-3.8 0-0 1-1.9 1-1.9 8-6-10 2-0-11 14-7-5 5-11-7 20-6-11 6-0-11 26-7-6 4-2-1 30-9-7 4-1-9 1-3.8
Scale = 1:57.6

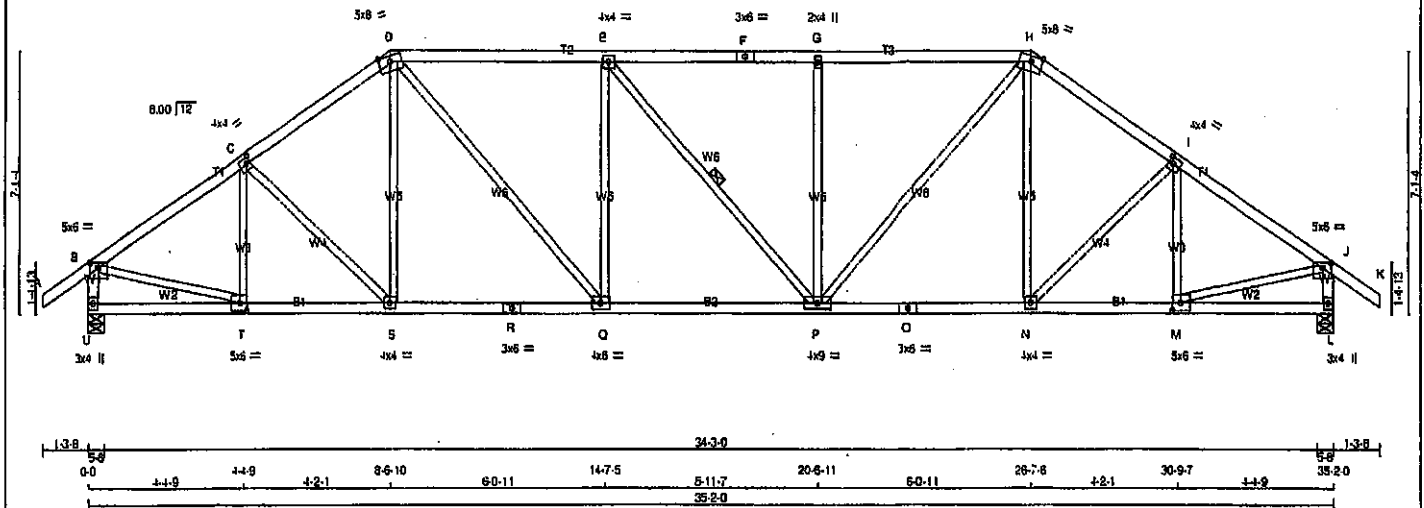

TOTAL WEIGHT = 2 X 155 = 308 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
U - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
BEARINGS							
	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	RECORD			
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
U	2065	0	2065	0	0	5-8	5-8
L	2065	0	2065	0	0	5-8	5-8

UNFACTORED REACTIONS							
JT	COMBINED	SNOW	MAX. MIN. COMPONENT REACTIONS	LIVE	PERM. LIVE	WIND	DEAD
U	1458	970	0	0	0	0	488
L	1458	970	0	0	0	0	488

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING			
TOTAL LOAD CASES: (4)			
CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)
FR-TO			
A-B	0 35	-81.8	-91.8 0.12 (1)
B-C	-2269 0	-81.8	-91.8 0.37 (1)
C-D	-2254 0	-91.8	-91.8 0.36 (1)
D-E	-2485 0	-91.8	-91.8 0.64 (1)
E-F	-2483 0	-91.8	-91.8 0.64 (1)
F-G	-2483 0	-91.8	-91.8 0.64 (1)
G-H	-2483 0	-91.8	-91.8 0.63 (1)
H-I	-2254 0	-91.8	-91.8 0.36 (1)
I-J	-2269 0	-91.8	-91.8 0.37 (1)
J-K	0 35	-91.8	-91.8 0.12 (1)
U-B	-2027 0	0.0	0.0 0.21 (1)
L-J	-2026 0	0.0	0.0 0.21 (1)
U-T	0 0	-18.5	-18.5 0.08 (4)
T-S	0 1908	-18.5	-18.5 0.37 (1)
S-R	0 1853	-18.5	-18.5 0.36 (1)
R-Q	0 1853	-18.5	-18.5 0.36 (1)
Q-P	0 2485	-18.5	-18.5 0.47 (1)
P-O	0 1854	-18.5	-18.5 0.36 (1)
O-N	0 1854	-18.5	-18.5 0.36 (1)
N-M	0 1908	-18.5	-18.5 0.37 (1)
M-L	0 0	-18.5	-18.5 0.08 (4)
WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	FR-TO
T-C	-397 0	0.11 (1)	
C-S	-78 0	0.05 (1)	
S-D	0 155	0.04 (4)	
D-Q	0 949	0.21 (1)	
Q-E	-597 0	0.52 (1)	
E-P	-2 0	0.00 (1)	
P-G	-597 0	0.52 (1)	
H-P	0 947	0.21 (1)	
N-H	0 157	0.04 (4)	
N-L	-78 0	0.05 (1)	
M-I	-397 0	0.11 (1)	
B-T	0 1985	0.44 (1)	
M-J	0 1985	0.44 (1)	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSK: TC=0.64/1.00 (D:E:1), BC=0.47/1.00 (P-Q:1), WB=0.52/1.00 (E-Q:1), SS=0.26/1.00 (D:E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1897
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (D); INPUT = 0.90 ;
JSI METAL= 0.62 (C); INPUT = 1.00 ;

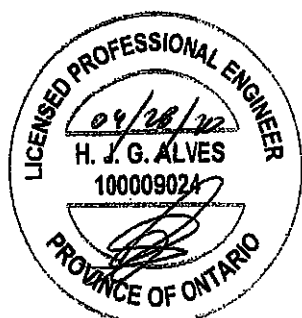

Structural component only
DWG# T-2007606


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T5	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:00:08 2020 Page 1

ID:DMCubINVR6TsFoe31v6I zns1I-BXPq ODBdXYU8fY7bRV048iM4gExZrD7oS52NzMFib

1-3.8 0-0 5-1-9 5-1-9 4-11-1 10-0-10 7-6-6 17-7-0 7-6-6 25-1-6 4-11-1 30-0-7 5-1-9 35-2-0 1-3-8
Scale = 1:57.6

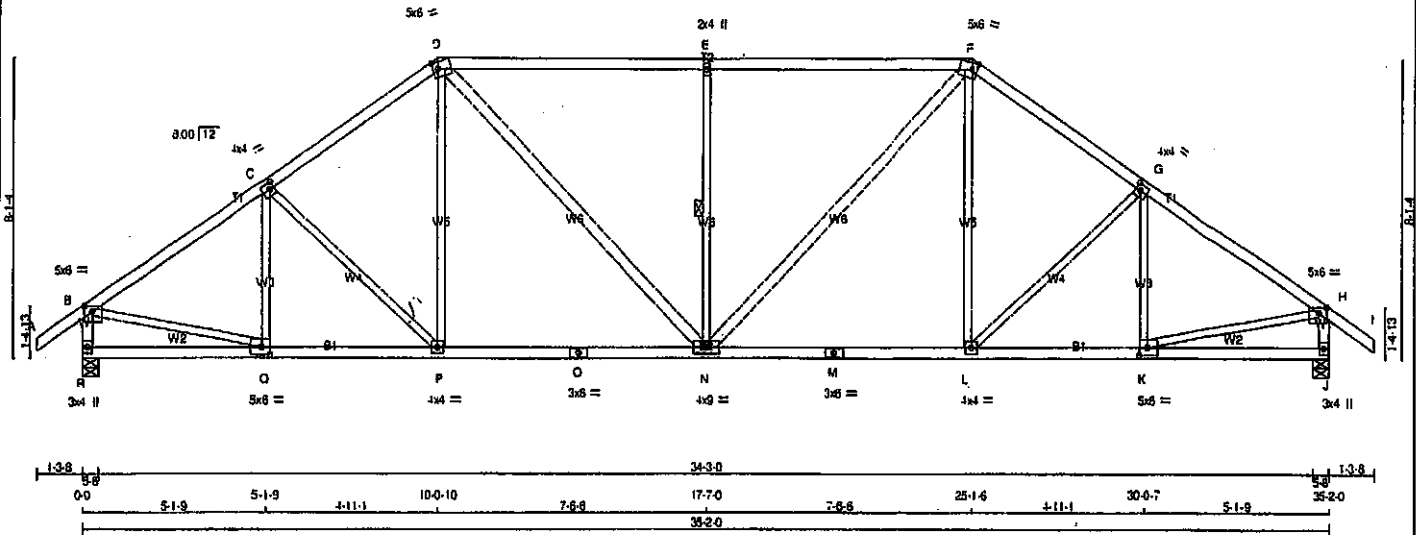

TOTAL WEIGHT = 2 X 158 = 317 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No. 2	SPF	
E - F	2x4	DRY	No. 2	SPF	
G - H	2x4	DRY	No. 2	SPF	
I - J	2x4	DRY	No. 2	SPF	
K - L	2x4	DRY	No. 2	SPF	
M - N	2x4	DRY	No. 2	SPF	
O - P	2x4	DRY	No. 2	SPF	
Q - R	2x4	DRY	No. 2	SPF	
ALL WEBS	2x3	DRY	No. 2	SPF	
EXCEPT					
D - N	2x4	DRY	No. 2	SPF	
N - F	2x4	DRY	No. 2	SPF	

DRY: SEASONED LUMBER.

PLATES (table in inches)	W	LEN	Y	X
JT TYPE PLATES				
B TMWW-p	MT20	5.0	8.0	1.75 2.75
C TMWW-l	MT20	4.0	4.0	2.00 1.50
D TMWW-m	MT20	5.0	8.0	2.25 1.75
E TMWW-w	MT20	2.0	4.0	
F TMWW-m	MT20	5.0	8.0	2.25 1.75
G TMWW-l	MT20	4.0	4.0	2.00 1.50
H TMWW-p	MT20	5.0	8.0	1.75 2.75
J BMW-lp	MT20	3.0	4.0	
K BMWW-l	MT20	5.0	8.0	2.50 2.75
L BMWW-l	MT20	4.0	4.0	
M BS-l	MT20	3.0	8.0	
N BMWW-l	MT20	4.0	9.0	
O BS-l	MT20	3.0	8.0	
P BMWW-l	MT20	4.0	1.0	
Q BMWW-l	MT20	5.0	8.0	2.50 2.75
R BMW-lp	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORIZ	DOWN	HORIZ
R	2055	0	2055	0
J	2055	0	2055	0

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
R	1458 970 0 0 0 0 0 0 488 0 0 0
J	1458 970 0 0 0 0 0 0 488 0 0 0

BEARING MATERIAL TO BE SPF NO. 2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX	MAX	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 (LC)	UNBRAC	MEMB.	FORCE (LBS)
FR-TO		FROM		LENGTH	FR-TO	
A-B	0 35	-91.8	-91.8 0.12 (1)	10.00	Q-C	-321 0
B-C	-2317 0	-91.8	-91.8 0.38 (1)	4.16	C-P	-218 0
C-D	-2185 0	-91.8	-91.8 0.37 (1)	4.28	P-D	0 266
D-E	-2274 0	-91.8	-91.8 0.81 (1)	3.47	D-N	0 691
E-F	-2274 0	-91.8	-91.8 0.81 (1)	3.47	N-E	-851 0
F-G	-2185 0	-91.8	-91.8 0.37 (1)	4.28	N-F	0 691
G-H	-2317 0	-91.8	-91.8 0.38 (1)	4.16	L-F	0 268
H-I	0 35	-91.8	-91.8 0.12 (1)	10.00	L-G	-218 0
R-B	-2022 0	0.0	0.0 0.21 (1)	5.94	K-G	-321 0
J-H	-2022 0	0.0	0.0 0.21 (1)	5.94	B-Q	0 1995
R-Q	0 0	-18.5	-18.5 0.10 (4)	10.00	K-H	0 1995
Q-P	0 1953	-18.5	-18.5 0.40 (1)	10.00		
P-O	0 1794	-18.5	-18.5 0.41 (1)	10.00		
O-N	0 1794	-18.5	-18.5 0.41 (1)	10.00		
N-M	0 1794	-18.5	-18.5 0.41 (1)	10.00		
M-L	0 1794	-18.5	-18.5 0.41 (1)	10.00		
L-K	0 1953	-18.5	-18.5 0.40 (1)	10.00		
K-J	0 0	-18.5	-18.5 0.10 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.11')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.22')

CSL: TC=0.81 (1.00 (E-F:1), BC=0.41 (1.00 (L-N:1), WB=0.45 (1.00 (H-K:1), SL=0.34 (1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1887 788 1887 1856

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (H) (INPUT = 0.90)
JSI METAL= 0.84 (M) (INPUT = 1.00)

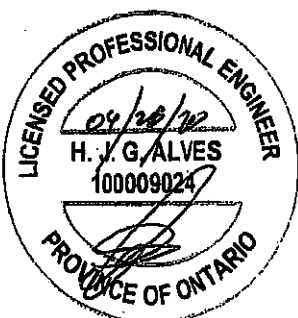

Structural component only
DWG# T-2007607

JOB NAME 408222	TRUSS NAME T6	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

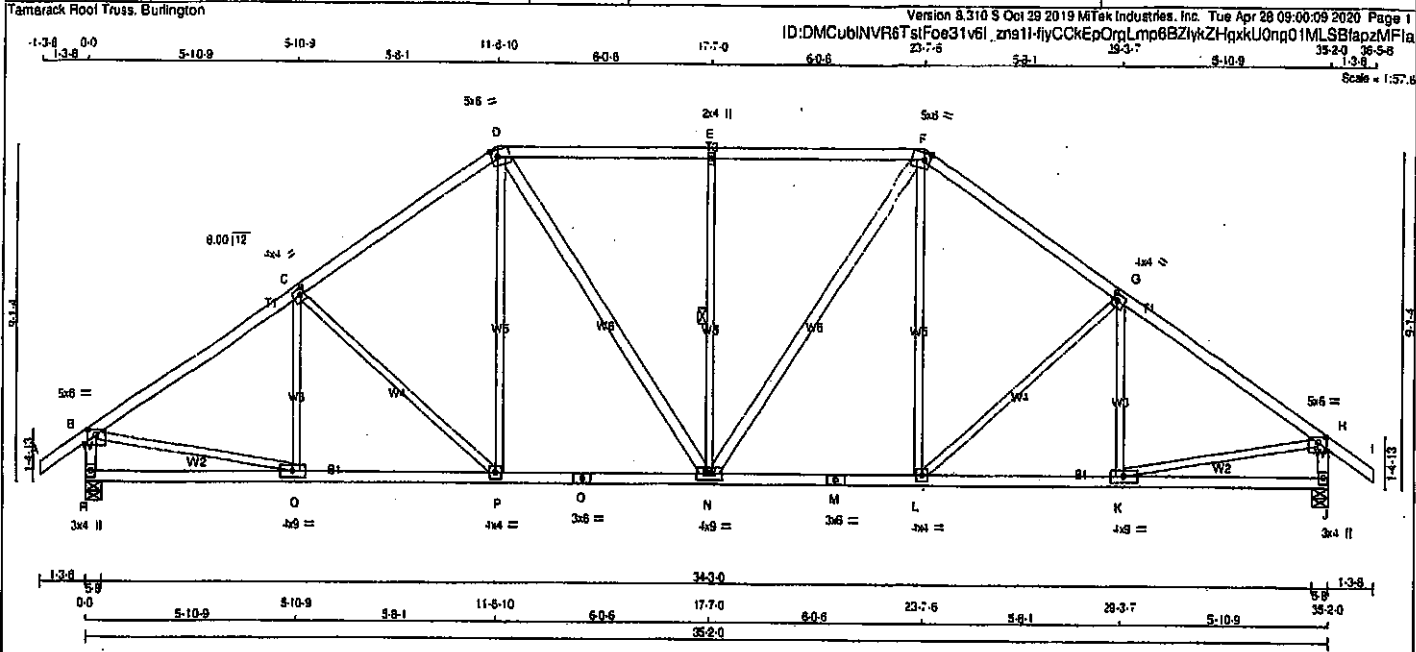

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)				
JT	TYPE	PLATES	W.	LEN Y X
B	TMW-p	MT20	5.0	6.0 1.75 2.75
C	TMW-l	MT20	4.0	4.0 2.00 1.50
D	TMW-m	MT20	5.0	6.0 2.25 2.00
E	TMW-w	MT20	2.0	4.0
F	TMW-m	MT20	5.0	6.0 2.25 2.00
G	TMW-l	MT20	4.0	4.0 2.00 1.50
H	TMW-p	MT20	5.0	6.0 1.75 2.75
J	BMV-l-p	MT20	3.0	4.0
K	BMW-l	MT20	4.0	9.0
L	BMW-l	MT20	4.0	4.0
N	BS-l	MT20	3.0	6.0
M	BMW-l	MT20	4.0	9.0
O	BS-l	MT20	3.0	6.0
P	BMW-l	MT20	4.0	4.0
Q	BMW-l	MT20	4.0	9.0
R	BMV-l-p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	VERT	GROSS REACTION	DOWN	BRG	BRG
R	2065	0	2065	0	5-8
J	2065	0	2065	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1458	970	0	0	0	0	488	0
J	1458	970	0	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PL)	MAX. (LBS)	MEMB.	FORCE (LBS)	MAX. (LBS)	MAX. (LBS)
FR-TO		FROM TO		FR-TO			
A-B	0 35	-91.8 -91.8 0.12 (1)	10.00	C-C	-249 11	0.11 (1)	
B-C	-2346 0	-91.8 -91.8 0.52 (1)	3.99	C-P	-356 0	0.42 (1)	
C-D	-2095 0	-91.8 -91.8 0.48 (1)	4.22	P-D	0 341	0.08 (1)	
D-E	-1985 0	-91.8 -91.8 0.49 (1)	4.20	D-N	0 477	0.08 (1)	
E-F	-1985 0	-91.8 -91.8 0.49 (1)	4.20	N-E	-678 0	0.37 (1)	
F-G	-2095 0	-91.8 -91.8 0.48 (1)	4.22	N-F	0 477	0.08 (1)	
G-H	-2346 0	-91.8 -91.8 0.52 (1)	3.99	L-F	0 341	0.08 (1)	
H-I	0 35	-91.8 -91.8 0.12 (1)	10.00	L-G	-356 0	0.42 (1)	
R-B	-2018 0	0.0 0.0 0.21 (1)	5.84	K-G	-249 11	0.11 (1)	
J-H	-2018 0	0.0 0.0 0.21 (1)	5.84	G-Q	0 2014	0.45 (1)	
				K-H	0 2014	0.45 (1)	
R-Q	0 0	-18.5 -18.5 0.14 (4)	10.00				
O-P	0 1980	-18.5 -18.5 0.39 (1)	10.00				
P-O	0 1716	-18.5 -18.5 0.34 (1)	10.00				
O-N	0 1716	-18.5 -18.5 0.34 (1)	10.00				
N-M	0 1716	-18.5 -18.5 0.34 (1)	10.00				
M-L	0 1716	-18.5 -18.5 0.34 (1)	10.00				
L-K	0 1981	-18.5 -18.5 0.39 (1)	10.00				
K-J	0 0	-18.5 -18.5 0.14 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN PLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L 300 (1.17")
CALCULATED VERT. DEFL.(LL) = L 999 (0.10")
ALLOWABLE DEFL.(TL) = L 360 (1.17")
CALCULATED VERT. DEFL.(TL) = L 999 (0.19")

CS: TC=0.52/1.00 (G-H:1), BC=0.39/1.00 (K-L:1),
WB=0.45/1.00 (H-K:1), SS=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 L.S BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLS) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (H) INPUT = 0.90
JSI METAL = 0.56 (M) INPUT = 1.00



Structural component only
DWG# T-2007608

JOB NAME 408266	TRUSS NAME T9	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 M/Tek Industries, Inc. Tue Apr 28 09:28:00 2020 Page 1 ID:DMCubINVR6TslF0e31v6L_zns11H6AY14717N5GLABHwYHSwMPwMINRZVE1?GPEXPzMEwL	
-1-3-8 0-0 1-3-8 4-0-10 4-0-10 5-5-6 9-6-0 5-5-6 14-11-8 4-0-10 19-0-0 1-3-8 Scale = 1:32.9					

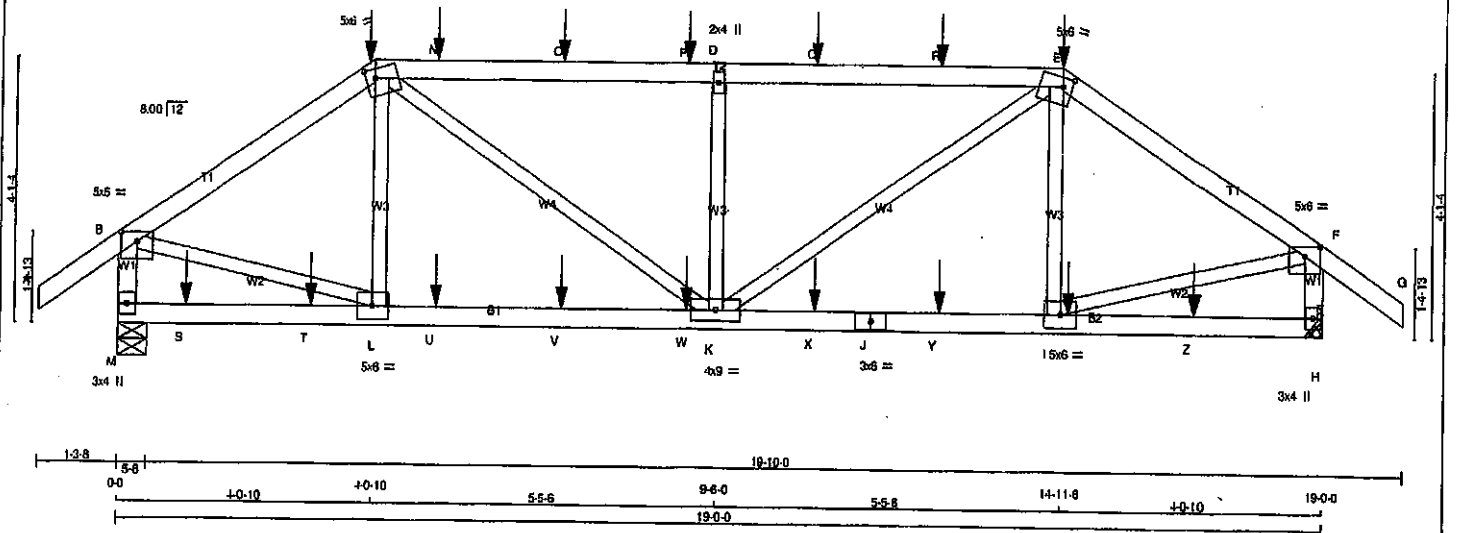

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	1650F 1.5E
E - G	2x4	DRY	No.2
M - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
M - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

PLATES (tab/e in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	6.0	1.75 3.00
C	TTWW-m	MT20	5.0	6.0	1.75 1.75
D	TMW-w	MT20	2.0	4.0	
E	TTWW-m	MT20	5.0	6.0	1.75 1.75
F	TMWV-p	MT20	5.0	6.0	1.75 3.00
H	BMV1+p	MT20	3.0	4.0	
I	BMWV-l	MT20	5.0	6.0	
J	BS-l	MT20	3.0	6.0	
K	BMWV-l	MT20	4.0	9.0	
L	BMWV-l	MT20	5.0	6.0	
M	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
BEARINGS							
	FACTORED	MAXIMUM FACTORED	INPUT	REQD			
	GROSS REACTION	GROSS REACTION	BRG	BRG			
JT	VERT	HORZ	DOWN	UPLIFT	IN-SX	IN-SX	
M	1915	0	1915	0	5-8	5-8	
H	1946	0	1946	0	MECHANICAL		

UNFACTORED REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
M	1352	901.0	0.0	0.0	0.0	452.0
H	1372	922.0	0.0	0.0	0.0	450.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO				FR-TO			
A-B	0.735	-91.8	0.14 (1)	10.00	L-C	-285	42
B-C	-2012.0	-91.8	0.37 (1)	4.35	C-K	0	1024
C-N	-2504.0	-91.8	0.77 (1)	3.76	K-D	-975	0
N-O	-2504.0	-91.8	0.77 (1)	3.76	D-E	0	971
O-P	-2504.0	-91.8	0.77 (1)	3.76	E-F	-279	37
P-D	-2504.0	-91.8	0.77 (1)	3.76	F-L	0	1727
D-Q	-2504.0	-91.8	0.77 (1)	3.76	L-F	0	1772
Q-R	-2504.0	-91.8	0.77 (1)	3.76			
R-E	-2504.0	-91.8	0.77 (1)	3.76			
E-F	-2065.0	-91.8	0.38 (1)	4.30			
F-G	0.735	-91.8	0.14 (1)	10.00			
M-B	-1867.0	0.0	0.0	0.21 (1)	6.09		
H-F	-1908.0	0.0	0.0	0.22 (1)	6.03		

M-S	0.0	-18.5	-18.5	0.19 (4)	10.00
S-T	0.0	-18.5	-18.5	0.19 (4)	10.00
T-L	0.0	-18.5	-18.5	0.19 (4)	10.00
L-U	0.1864	-18.5	-18.5	0.40 (1)	10.00
U-V	0.1864	-18.5	-18.5	0.40 (1)	10.00
V-W	0.1864	-18.5	-18.5	0.40 (1)	10.00
W-K	0.1864	-18.5	-18.5	0.40 (1)	10.00
K-X	0.1707	-18.5	-18.5	0.39 (1)	10.00
X-J	0.1707	-18.5	-18.5	0.39 (1)	10.00
J-Y	0.1707	-18.5	-18.5	0.39 (1)	10.00
Y-I	0.1707	-18.5	-18.5	0.39 (1)	10.00
I-Z	0.0	-18.5	-18.5	0.17 (4)	10.00
Z-H	0.0	-18.5	-18.5	0.17 (4)	10.00

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE
C	4-0-10	-49	-55		FRONT	VERT	DEAD
C	4-0-10	-255	-255		FRONT	VERT	SNOW
E	14-11-6	-49	-55		FRONT	VERT	DEAD
E	14-11-6	-117	-117		FRONT	VERT	TOTAL
E	14-11-6	-255	-255		FRONT	VERT	SNOW
I	15-0-12	-26	-26		FRONT	VERT	TOTAL
N	5-0-12	-110	-110		FRONT	VERT	TOTAL
O	7-0-12	-110	-110		FRONT	VERT	TOTAL
P	9-0-12	-110	-110		FRONT	VERT	TOTAL

TOTAL WEIGHT = 78 lb (M)

DESIGN CRITERIA
*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.63")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (0.63")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.77/1.00 (D-E:1), BC=0.40/1.00 (K-L:1), WB=0.44/1.00 (F-I:1), SS=0.45/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (I) (INPUT = 0.90)

JSI METAL = 0.82 (I) (INPUT = 1.00)

CONTINUED ON PAGE 2



Structural component only
DWG# T-2007687

JOB NAME 408266	TRUSS NAME T9	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Tue Apr 28 09:26:00 2020 Page 2
 ID:DMCubINVR6TsIFoe31v6I zns11-6AY477N5GLABHwYHSwMPwMINRZVEI7GPEXPzMEwL


FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
Q	11-0-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
R	13-0-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
S	1-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	3-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
U	5-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
V	7-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
W	9-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
X	11-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Y	13-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Z	17-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
 DWG# T-2007687

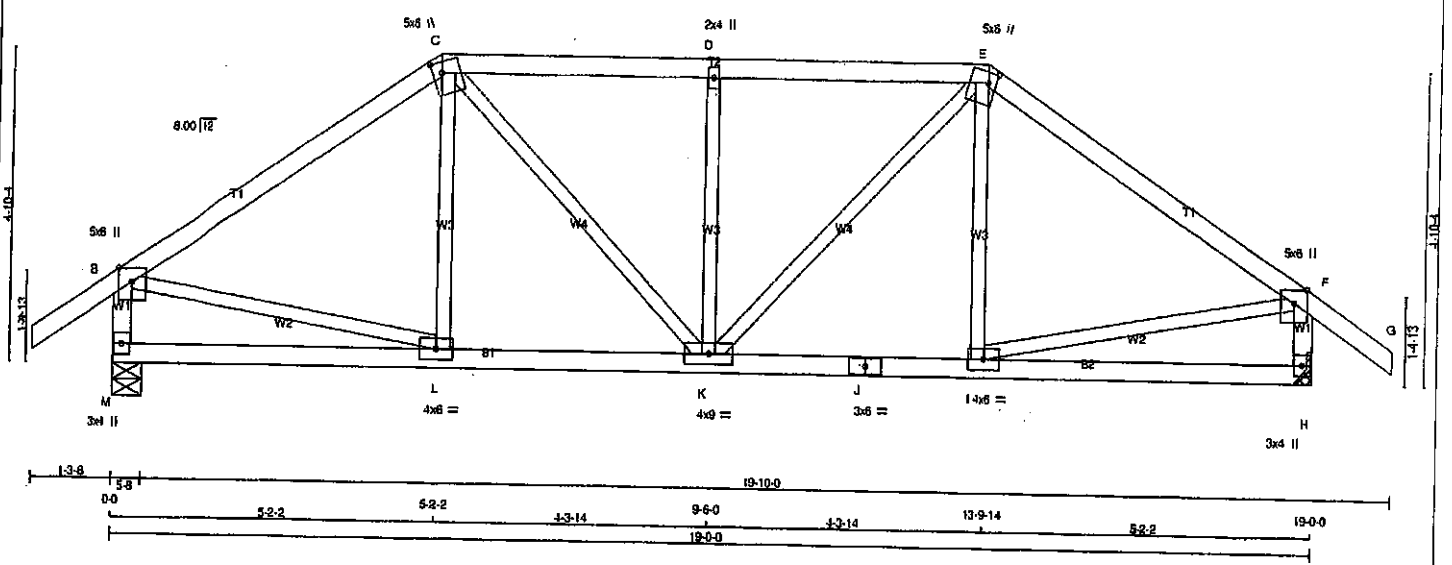

LUMBER					DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY										TOTAL WEIGHT = 80 lb	
N. L. G. A. RULES					BUILDING DESIGNER										[M/F]	
CHORDS	SIZE		LUMBER	DESCR.	BEARINGS										DESIGN CRITERIA	
A - C	2x4	DRY	No.2	SPF	FACTORED					MAXIMUM FACTORED					INPUT	REQD
C - E	2x4	DRY	No.2	SPF	GROSS REACTION					GROSS REACTION					BRG	BRG
E - G	2x4	DRY	No.2	SPF	JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG				
M - B	2x4	DRY	No.2	SPF	M	1173	0	1173	0	0	5-8	IN-SX				
H - F	2x4	DRY	No.2	SPF	H	1173	0	1173	0	0	MECHANICAL					
M - J	2x4	DRY	No.2	SPF	A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.										SPECIFIED LOADS:	
J - H	2x4	DRY	No.2	SPF											TOTAL LOAD = 39.0 PSF	
ALL WEBS	2x3	DRY	No.2	SPF											SPACING = 24.0 IN./C	
EXCEPT																

DRY: SEASONED LUMBER.

PLATES (table in inches)				UNFACTORED REACTIONS			
JT	TYPE	PLATES	W	LEN	Y	X	
B	TMWV+p	MT20	5.0	8.0	Edge		
C	TTWW+m	MT20	5.0	8.0	2.00	1.50	
D	TMW+w	MT20	2.0	4.0			
E	TTWW+m	MT20	5.0	8.0	2.00	1.50	
F	TMWV+p	MT20	5.0	8.0	Edge		
H	BMV1+p	MT20	3.0	4.0			
I	BMWV-t	MT20	4.0	6.0			
J	BS-t	MT20	3.0	6.0			
K	BMWV-t	MT20	4.0	6.0			
L	BMWV-t	MT20	4.0	6.0			
M	BMV1+p	MT20	3.0	4.0			

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.71 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
PR-TO		FROM	TO	FR-TO			
A-B	0.35	-91.8	-91.8 0.12 (1)	10.00	L-C	-75.55	0.03 (1)
B-C	-1059.0	-91.8	-91.8 0.33 (1)	5.71	C-K	0.373	0.08 (1)
C-D	-1136.0	-91.8	-91.8 0.23 (1)	5.71	K-D	-482.0	0.17 (1)
D-E	-1136.0	-91.8	-91.8 0.23 (1)	5.71	E-K	0.373	0.08 (1)
E-F	-1059.0	-91.8	-91.8 0.33 (1)	5.71	F-E	-75.55	0.03 (1)
F-G	0.35	-91.8	-91.8 0.12 (1)	10.00	G-L	0.899	0.20 (1)
M-B	-1133.0	0.0	0.0 0.12 (1)	7.48	F-F	0.899	0.20 (1)
H-F	-1133.0	0.0	0.0 0.12 (1)	7.48			
M-L	0.0	-18.5	-18.5 0.11 (4)	10.00			
L-K	0.879	-18.5	-18.5 0.20 (1)	10.00			
K-J	0.879	-18.5	-18.5 0.20 (1)	10.00			
J-I	0.879	-18.5	-18.5 0.20 (1)	10.00			
I-H	0.0	-18.5	-18.5 0.11 (4)	10.00			

ALLOWABLE DEFL.(LL) = L/360 (0.63")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.63")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CS1: TC=0.33/1.00 (B-C:1), BC=0.20/1.00 (K-L:1), WB=0.20/1.00 (B-L:1), SS=0.19/1.00 (C-D:1)

OOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.66 (B) (INPUT = 0.90)
JSI METAL = 0.46 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007688

JOB NAME 408266	TRUSS NAME T12	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

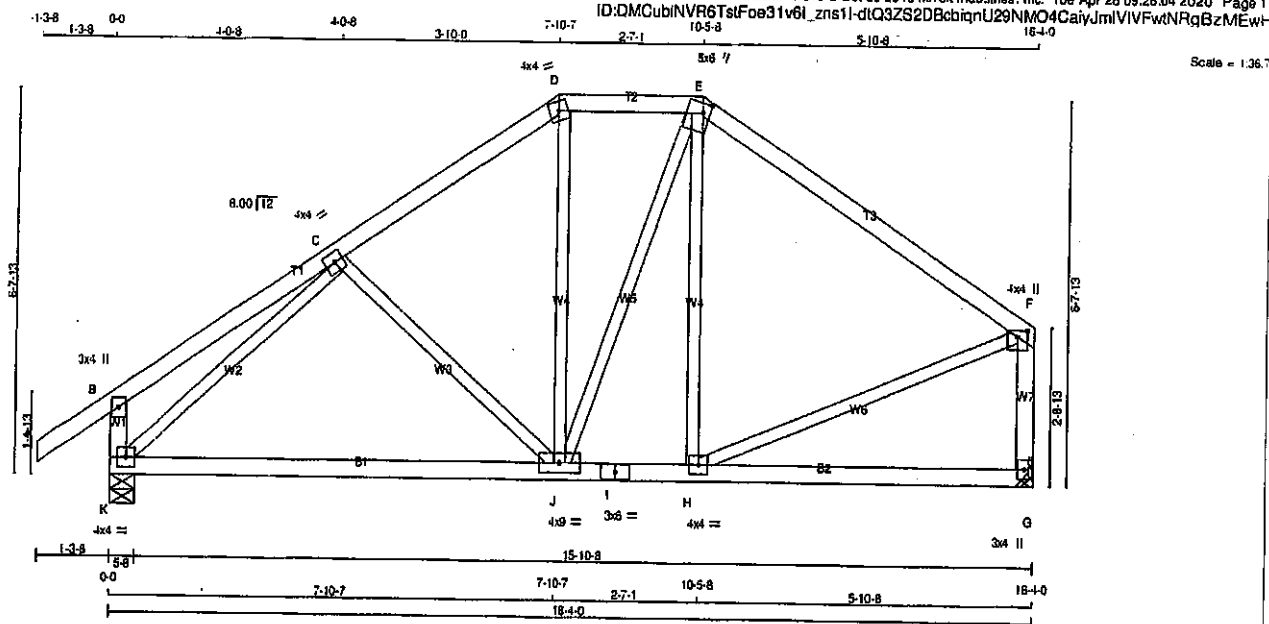

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4 DRY	No.2	SPF
D - E	2x4 DRY	No.2	SPF
E - F	2x4 DRY	No.2	SPF
K - B	2x4 DRY	No.2	SPF
G - F	2x4 DRY	No.2	SPF
K - I	2x4 DRY	No.2	SPF
I - G	2x4 DRY	No.2	SPF
ALL WEBS EXCEPT	2x3 DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
C	TMVW-l	MT20	4.0	4.0	
D	TTW-m	MT20	4.0	4.0	
E	TTWV+m	MT20	5.0	6.0	2.00 1.50
F	TMVW+p	MT20	4.0	4.0	1.25 2.00
G	BMV1+p	MT20	3.0	4.0	
H	BMVW-l	MT20	4.0	4.0	
I	BS-l	MT20	3.0	8.0	
J	BMVWV-l	MT20	4.0	9.0	
K	BMVW1-l	MT20	4.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	UP	IN-SX	BRG	IN-SX
K	1025	0	0	1025	0	0	5-8	5-8	
G	900	0	0	900	0	0	MECHANICAL		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3'-8".

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	723	488 / 0	0 / 0	0 / 0	0 / 0	0 / 0	235 / 0	0 / 0
G	637	418 / 0	0 / 0	0 / 0	0 / 0	0 / 0	219 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	MAX. UNBRACED LENGTH (LC)
FR-TO				FR-TO			
A-B	0 35	-91.8	-91.8 0.12 (1)	10.00	C-J	-207 0	0.11 (1)
B-C	0 23	-91.8	-91.8 0.23 (1)	10.00	J-D	0 138	0.03 (4)
C-D	-735 0	-91.8	-91.8 0.18 (1)	6.25	J-E	0 144	0.03 (1)
D-E	-593 0	-91.8	-91.8 0.08 (1)	6.25	H-E	-158 0	0.12 (1)
E-F	-654 0	-91.8	-91.8 0.41 (1)	6.25	K-C	-1023 0	0.48 (1)
K-B	-264 0	0.0	0.0 0.03 (1)	7.81	H-F	0 588	0.13 (1)
G-F	-853 0	0.0	0.0 0.12 (1)	7.81			
K-J	0 744	-18.5	-18.5 0.31 (4)	10.00			
J-I	0 541	-18.5	-18.5 0.30 (4)	10.00			
I-H	0 541	-18.5	-18.5 0.30 (4)	10.00			
H-G	0 0	-18.5	-18.5 0.14 (4)	10.00			

TOTAL WEIGHT = 75 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

15% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
CALCULATED VERT. DEFL.(LL) = U/899 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.54")
CALCULATED VERT. DEFL.(TL) = U/899 (0.12")

CSI: TC=0.41/1.00 (E-F:1), BC=0.31/1.00 (J-K:4), WS=0.49/1.00 (C-K:1), SSI=0.17/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEAM=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.88 (K) (INPUT = 0.90)
JSI METAL= 0.40 (I) (INPUT = 1.00)



Structural component only
DWG# T-2007690

JOB NAME 408266	TRUSS NAME T14	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	ORWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:28:08 2020 Page 1
ID:DMCubINVR6TslFae31v8l_zns11-aGYP_74TDQ35eRHcOs9df2p6UKzIEYNBSyK3zMEwF

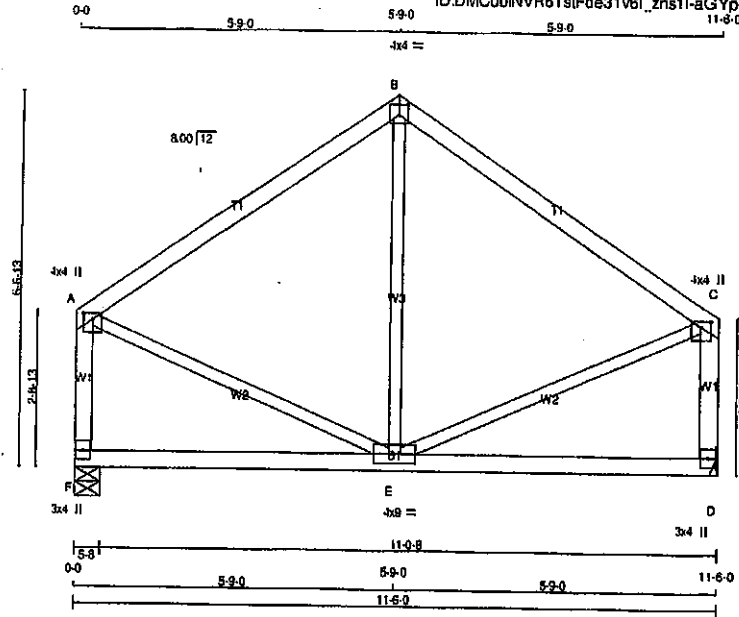

Scale = 1:37.2

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
F - A	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25 2.00
B	TTW+p	MT20	4.0	4.0	2.25 2.00
C	TMVW+p	MT20	4.0	4.0	1.25 2.00
D	BMV+p	MT20	3.0	4.0	
E	BMVWV-1	MT20	4.0	9.0	
F	BMV+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG	BRG
P	634 0	634 0 0	5-8	5-8	
D	634 0	634 0 0	MECHANICAL		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

UNFACTORED REACTIONS

JT	1ST LGASE	MAX. MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
F	448	294 / 0	0 / 0	154 / 0	0 / 0
D	448	294 / 0	0 / 0	154 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. GSI (LC)	MEMB.	FORCE (LBS)	MAX. GSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	-365 0	-91.8 -91.8	0.39 (1)	E-B	-123 54	0.09 (1)	
B-C	-365 0	-91.8 -91.8	0.39 (1)	A-E	0 329	0.07 (1)	
F-A	-583 0	0.0 0.0	0.09 (1)	E-C	0 329	0.07 (1)	
D-C	-583 0	0.0 0.0	0.09 (1)				
F-E	0 0	-18.5 -18.5	0.18 (4)				
E-D	0 0	-18.5 -18.5	0.18 (4)				

TOTAL WEIGHT = 3 X 49 = 147 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.38")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.38")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSK: TC=0.39/1.00 (B-C:1), BC=0.18/1.00 (E-F:4), WB=0.09/1.00 (B-E:1), SS=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1887 1686



PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.41 (C) (INPUT = 0.90)
JSI METAL = 0.12 (A) (INPUT = 1.00)




Structural component only
DWG# T-2007692

Scale 1: 37.2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408266	T15	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:28:07 2020 Page 1
ID:DMCubINVR6TsiFoe31v6l_zns11-2S58BT55UXzhFDdqWv5iqCCKW99jkhcrb5GWzMEwE

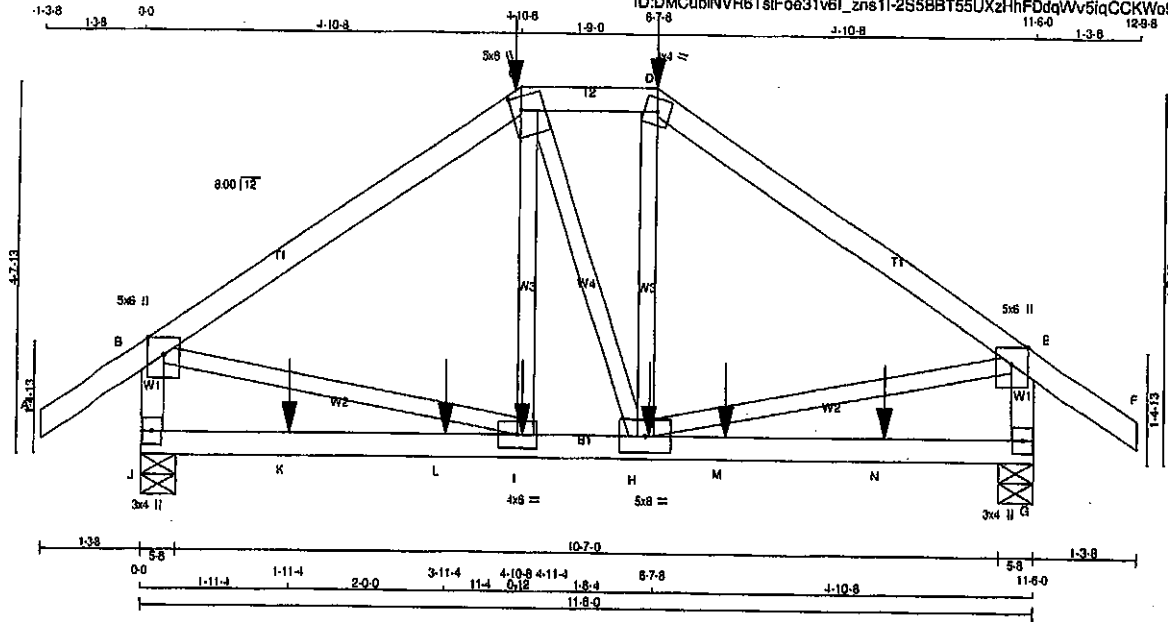

Scale = 1:26.7

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - G	2x4	DRY	No.2	SPF	
C - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
J - B	2x4	DRY	No.2	SPF	
G - E	2x4	DRY	No.2	SPF	
J - G	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMW+p	MT20	5.0	6.0	Edge	
C	TTW+m	MT20	5.0	6.0	2.00	1.50
D	TTW-m	MT20	4.0	4.0		
E	TMW+p	MT20	5.0	6.0	Edge	
G	BMV1+p	MT20	3.0	4.0		
H	BMWWW-1	MT20	5.0	6.0		
I	BMWW-1	MT20	4.0	6.0		
J	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
J	1274	0	1274	0	0	5-8	5-8	5-8	5-8
G	1274	0	1274	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	899	603 / 0	0 / 0	0 / 0	0 / 0	296 / 0	0 / 0
G	899	603 / 0	0 / 0	0 / 0	0 / 0	296 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.21 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)
FR-TO		FROM TO		FR-TO	
A-B	0 35	-91.8 -91.8	0.14 (1)	I-C	-83 73
B-C	-1179 0	-91.8 -91.8	0.47 (1)	C-H	0 4
C-D	-978 0	-91.8 -91.8	0.08 (1)	H-D	-82 77
D-E	-1180 0	-91.8 -91.8	0.47 (1)	B-I	0 1002
E-F	0 35	-91.8 -91.8	0.14 (1)	H-E	0 1003
J-B	-1218 0	0 0	0.14 (1)		
G-E	-1217 0	0 0	0.14 (1)		
J-K	0 0	-18.5 -18.5	0.18 (4)		
K-L	0 0	-18.5 -18.5	0.18 (4)		
L-I	0 0	-18.5 -18.5	0.18 (4)		
I-H	0 978	-18.5 -18.5	0.27 (4)		
H-M	0 0	-18.5 -18.5	0.19 (4)		
M-N	0 0	-18.5 -18.5	0.19 (4)		
N-G	0 0	-18.5 -18.5	0.19 (4)		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LOC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-10-8	-434	-434	---	BACK	VERT	TOTAL	---	C1
D	8-7-8	-434	-434	---	BACK	VERT	TOTAL	---	C1
H	8-6-12	-27	-27	---	BACK	VERT	TOTAL	---	C1
I	4-11-4	-27	-27	---	BACK	VERT	TOTAL	---	C1
K	1-11-4	-27	-27	---	BACK	VERT	TOTAL	---	C1
L	3-11-4	-27	-27	---	BACK	VERT	TOTAL	---	C1
M	7-8-12	-27	-27	---	BACK	VERT	TOTAL	---	C1
N	9-8-12	-27	-27	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2015, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.38")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.38")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.47/1.00 (D-E:1), BC=0.27/1.00 (H-I:4),
WB=0.25/1.00 (E-H:1), SSI=0.16/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1887 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.74 (E) (INPUT = 0.80)
JSI METAL= 0.51 (E) (INPUT = 1.00)



Structural component only
DWG# T-2007693

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408266	T16	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2018 MITek Industries, Inc. Tue Apr 28 09:28:08 2020 Page 1					
ID:DMCubINVR6TstFoe31v6I_zns11-WifaPp5JFr58IPoqODOKE2IRVw6CR8PrVLlpzMEwD					
Scale = 1:38.5					

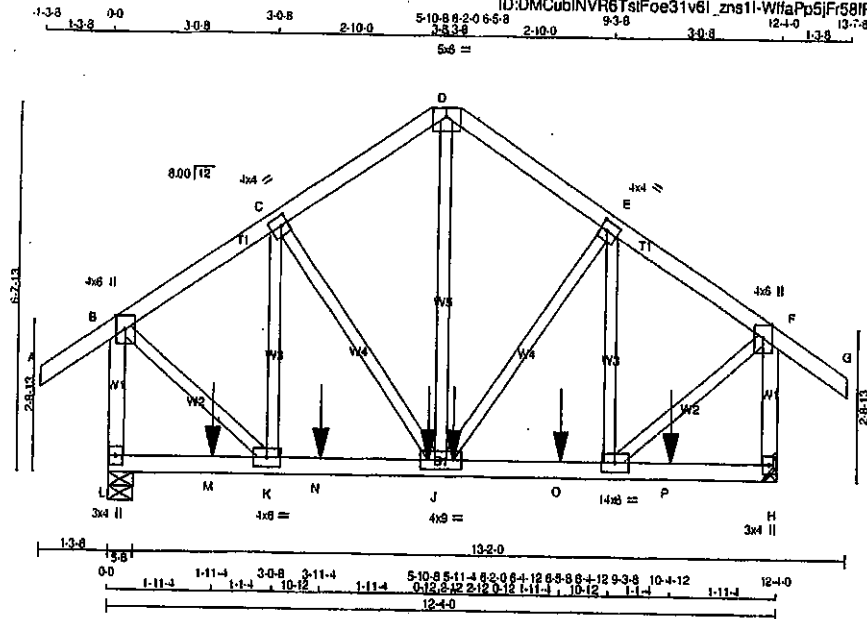

LUMBER	N L G A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4 DRY	No.2		
D - G	2x4 DRY	No.2		
L - B	2x4 DRY	No.2		
H - F	2x4 DRY	No.2		
L - H	2x4 DRY	No.2		

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	6.0	Edge	
C TMVW-i	MT20	4.0	4.0	2.00	1.50
D TMTWM-m	MT20	5.0	6.0	Edge	3.00
E TMVW-i	MT20	4.0	4.0	2.00	1.50
F TMVW+p	MT20	4.0	6.0	Edge	
H BMV1+p	MT20	3.0	4.0		
I BMVW-i	MT20	4.0	6.0		
J BMVW-i	MT20	4.0	9.0		
K BMVW-i	MT20	4.0	6.0		
L BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT HORZ	DOWN HORZ UPLIFT	IN-SX	IN-SX
L 1699 0	1699 0 0	5-8	5-8
H 1699 0	1699 0 0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

1ST LOOSE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
L	1194	825 / 0	0 / 0	0 / 0	0 / 0	370 0	0 0
H	1194	825 / 0	0 / 0	0 / 0	0 / 0	370 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.79 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)
FR-TO					FR-TO			
A-B	0 35	-91.8	-91.8	0.14 (1)	10.00	K-C	-206 0	0.07 (1)
B-C	-1121 0	-91.8	-91.8	0.15 (1)	5.79	C-J	-112 0	0.06 (1)
C-D	-1075 0	-91.8	-91.8	0.15 (1)	5.88	J-E	-112 0	0.06 (1)
D-E	-1075 0	-91.8	-91.8	0.15 (1)	5.88	E-I	-206 0	0.07 (1)
E-F	-1121 0	-91.8	-91.8	0.15 (1)	5.79	B-K	0 1208	0.30 (1)
F-G	0 35	-91.8	-91.8	0.14 (1)	10.00	I-F	0 1208	0.30 (1)
L-B	-1618 0	0.0	0.0	0.25 (1)	6.48	J-D	0 946	0.23 (1)
H-F	-1618 0	0.0	0.0	0.25 (1)	6.48			
L-M	0 0	-18.5	-18.5	0.24 (1)	10.00			
M-K	0 0	-18.5	-18.5	0.24 (1)	10.00			
K-N	0 946	-18.5	-18.5	0.41 (1)	10.00			
N-J	0 946	-18.5	-18.5	0.41 (1)	10.00			
J-O	0 946	-18.5	-18.5	0.40 (1)	10.00			
O-I	0 946	-18.5	-18.5	0.40 (1)	10.00			
I-P	0 0	-18.5	-18.5	0.24 (1)	10.00			
P-H	0 0	-18.5	-18.5	0.24 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
J	5-11-4	-297	-297	---	BACK	VERT	TOTAL	---	C1
J	6-4-12	-297	-297	---	BACK	VERT	TOTAL	---	C1
M	1-11-4	-291	-291	---	BACK	VERT	TOTAL	---	C1
N	3-11-4	-305	-305	---	BACK	VERT	TOTAL	---	C1
O	8-4-12	-305	-305	---	BACK	VERT	TOTAL	---	C1
P	10-4-12	-291	-291	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) G1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 66 lb [M]

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.41")
CALCULATED VERT. DEFL.(LL) = L/989 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.41")
CALCULATED VERT. DEFL.(TL) = L/989 (0.04")

CS: TC=0.25/1.00 (B-L:1), BC=0.41/1.00 (J-K:1), WB=0.30/1.00 (B-K:1), SS=0.24/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (B) (INPUT = 0.90)
JSI METAL = 0.58 (F) (INPUT = 1.00)



Structural component only
DWG# T-2007694

JOB NAME 408266	TRUSS NAME T17S	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

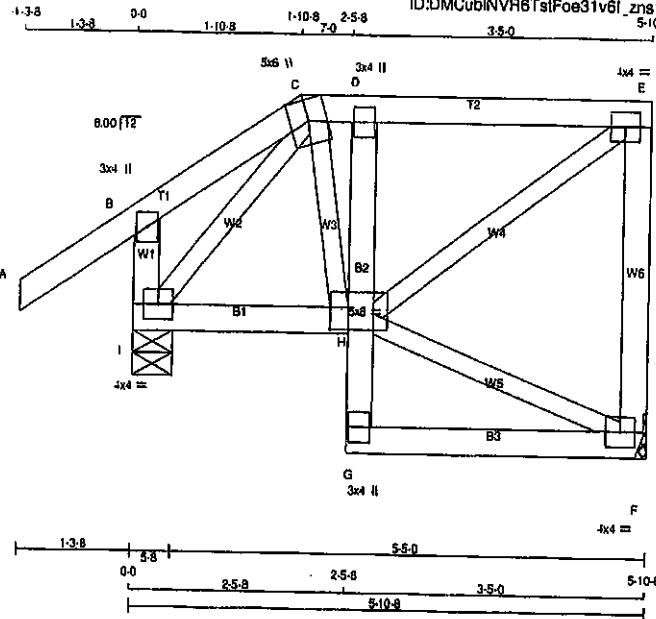

CHORDS	SIZE	LUMBER	DESCR.
I - B	2x4	DRY No.2	SPF
A - C	2x4	DRY No.2	SPF
C - E	2x4	DRY No.2	SPF
F - E	2x4	DRY No.2	SPF
I - H	2x4	DRY No.2	SPF
G - D	2x4	DRY No.2	SPF
G - F	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
DRY: SEASONED LUMBER.			

PLATE TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
C	TTWW+m	MT20	5.0	8.0	Edge
D	TMV+p	MT20	3.0	4.0	
E	BMVW1	MT20	4.0	4.0	
F	BMVW1	MT20	4.0	4.0	
G	BMV+p	MT20	3.0	4.0	
H	BMVW1	MT20	5.0	8.0	3.00 2.50
I	BMVW1	MT20	4.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT HORZ	DOWN HORZ	UPLIFT	IN-SX
I 465 0	465 0	0 5-8	5-8
F 309 0	309 0	0 0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1'-8".

UNFACTORED REACTIONS

1ST LCASE	MAX MIN. COMPONENT REACTIONS	PERM LIVE	WIND	DEAD	SOIL
JT COMBINED SNOW	LIVE				
I 326 229 / 0	0 / 0	0 / 0	0 / 0	97 / 0	0 / 0
F 219 142 / 0	0 / 0	0 / 0	0 / 0	77 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH
FR-TO						FR-TO			
I-B	-259 0	0.0	0.0	0.03 (1)	7.81	H-E	-6 0	0.00 (1)	
A-B	0 35	-91.8	-91.8	0.12 (1)	10.00	C-H	0 259	0.06 (1)	
B-C	-25 0	-91.8	-91.8	0.12 (1)	6.25	I-C	-234 0	0.05 (1)	
C-D	-214 0	-91.8	-91.8	0.11 (1)	6.25				
D-E	-210 0	-91.8	-91.8	0.12 (1)	6.25				
F-E	-277 0	0.0	0.0	0.07 (1)	7.81				
I-H	0 148	-18.5	-18.5	0.05 (4)	10.00				
G-H	0 34	0.0	0.0	0.02 (1)	10.00				
H-D	-327 0	0.0	0.0	0.01 (1)	7.81				
G-F	0 6	-18.5	-18.5	0.06 (4)	10.00				

TOTAL WEIGHT = 2 X 34 = 68 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.01")

CSI: TC=0.12/1.00 (A-B:1), BC=0.08/1.00 (F-G:4), WB=0.06/1.00 (E-H:1), SSI=0.14/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 6.0 Deg.

JSI GRIP = 0.26 (E) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007695

JOB NAME 408266	TRUSS NAME T19	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Metek Industries, Inc. Tue Apr 28 09:26:12 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-OCv4EB9E13bZn06bd3VGPuv1FXWnNykQm7JsyjzMEw9

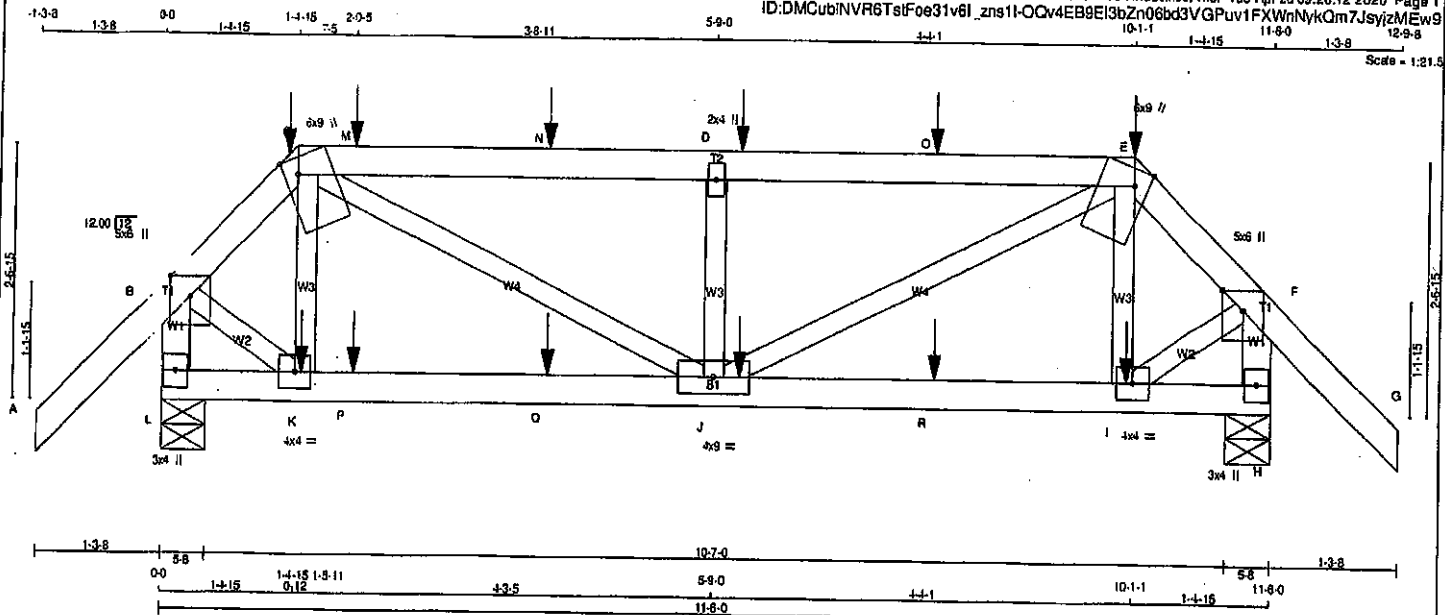

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
L - B	2x4	DRY	No.2
L - F	2x4	DRY	No.2
L - H	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	8.0	Edge	1.75
C	TTWW+m	MT20	6.0	9.0	Edge	1.75
D	TMVW+w	MT20	2.0	4.0		
E	TTWW+m	MT20	6.0	9.0	Edge	1.75
F	TMVW+p	MT20	5.0	8.0	Edge	
H	BMV1+p	MT20	3.0	4.0		
I	BMVW-t	MT20	4.0	4.0		
J	BMVW-t	MT20	4.0	9.0		
K	BMVW-t	MT20	4.0	4.0		
L	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG
L	1393	0	0	1393	0	0	0	5-8	5-8
H	1279	0	0	1279	0	0	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	993	857	0	0/0	0/0	0/0	327	0
H	993	803	0	0/0	0/0	0/0	300	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.43 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT.	PLF	MAX. (LBS)	UNBRACED LENGTH	MEMB.	FORCE (LBS)	MAX. (LBS)	CS1 (LC)
FR-TO						FR-TO			
A-B	0 45	-91.8	-91.8	0.14 (1)	10.00	K-C	-151	22	0.03 (1)
B-C	-1119 0	-91.8	-91.8	0.15 (1)	5.79	C-J	0	1028	0.25 (1)
C-M	-1657 0	-91.8	-91.8	0.52 (1)	4.43	J-D	-791	0	0.14 (1)
M-N	-1657 0	-91.8	-91.8	0.52 (1)	4.43	J-E	0	1117	0.28 (1)
N-D	-1657 0	-91.8	-91.8	0.52 (1)	4.43	E-I	-167	4	0.03 (1)
D-O	-1658 0	-91.8	-91.8	0.52 (1)	4.43	B-K	0	852	0.21 (1)
O-E	-1656 0	-91.8	-91.8	0.52 (1)	4.43	I-F	0	763	0.19 (1)
E-F	-1007 0	-91.8	-91.8	0.15 (1)	8.03				
F-G	0 45	-91.8	-91.8	0.14 (1)	10.00				
L-B	-1425 0	0.0	0.0	0.16 (1)	8.80				
H-F	-1303 0	0.0	0.0	0.15 (1)	7.03				
L-K	0 0	-18.5	-18.5	0.11 (4)	10.00				
K-P	0 745	-18.5	-18.5	0.24 (1)	10.00				
P-Q	0 745	-18.5	-18.5	0.24 (1)	10.00				
Q-J	0 745	-18.5	-18.5	0.24 (1)	10.00				
J-R	0 665	-18.5	-18.5	0.21 (1)	10.00				
R-I	0 665	-18.5	-18.5	0.21 (1)	10.00				
I-H	0 0	-18.5	-18.5	0.09 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	1-4-15	-131	-131		BACK	VERT	TOTAL		C1
D	8-0-5	-124	-124		BACK	VERT	TOTAL		C1
E	10-1-1	-131	-131		BACK	VERT	TOTAL		C1
I	10-0-5	-62	-62		BACK	VERT	TOTAL		C1
J	6-0-5	-62	-62		BACK	VERT	TOTAL		C1
K	1-5-11	-62	-62		BACK	VERT	TOTAL		C1
M	2-0-5	-142	-142		BACK	VERT	TOTAL		C1
N	4-0-5	-124	-124		BACK	VERT	TOTAL		C1
O	8-0-5	-124	-124		BACK	VERT	TOTAL		C1
P	2-0-5	-62	-62		BACK	VERT	TOTAL		C1
Q	4-0-5	-62	-62		BACK	VERT	TOTAL		C1
R	8-0-5	-62	-62		BACK	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) G1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 8.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.0W/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.38")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.38")
CALCULATED VERT. DEFL.(TL) = L/999 (0.06")

CS1: TC=0.52/1.00 (C-D:1), BC=0.24/1.00 (J-K:1).

WB=0.28/1.00 (E-J:1), SS1=0.31/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1687
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (I) (INPUT = 0.90)
JSI METAL = 0.37 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007697

JOB NAME 408267	TRUSS NAME T20	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:31:41 2020 Page 2
 ID:DMCubINVR8TsIFoe31v8I_zns1I-GiHSIq7cq92ulaIqPfvQEG1K9dMzcKsQpVm79zMEr0

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.50	4.00
C	TTWW+m	MT20	7.0	8.0	3.50	2.00
D	TMWW-t	MT20	5.0	6.0	2.50	2.50
E	TMWW-t	MT20	5.0	6.0		
F	TTWW+m	MT20	8.0	9.0		
G	TTWW+m	MT20	7.0	8.0	Edge	
H	TMWW+m	MT20	3.0	6.0		
I	TTWW+m	MT20	5.0	8.0	4.00	1.50
J	TMWW-t	MT20	5.0	6.0		
K	TMVW-t	MT20	6.0	9.0	2.50	4.50
M	BMV1+p	MT20	3.0	6.0	3.00	Edge
N	BMWW-t	MT20	8.0	9.0	4.50	3.00
O	BMWW-t	MT20	5.0	6.0		
P	BS-t	MT20	5.0	6.0		
Q	BMWWW-t	MT20	5.0	8.0		
R	BMWWW-t	MT20	6.0	9.0	4.50	2.25
S	BS-t	MT20	6.0	9.0		
T	BMWW-t	MT20	5.0	8.0		
U	BMWW-t	MT20	5.0	8.0	2.50	2.50
V	BMWW-t	MT20	6.0	9.0		
W	BMWW-t	MT20	5.0	8.0	2.50	2.00
X	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
N	30-5-8	-3728	-3728	---	BACK	VERT	TOTAL	---	C1
U	11-8-8	-2404	-2404	---	BACK	VERT	TOTAL	---	C1
V	7-7-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
Y	3-7-4	-138	-138	---	BACK	VERT	TOTAL	---	C1
Z	5-7-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AA	9-7-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AB	1-7-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AC	3-7-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AD	5-7-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AE	9-7-4	-26	-26	---	BACK	VERT	TOTAL	---	C1


CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
 DWG# T-2007701 92

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408267	T22	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Tue Apr 28 09:31:43 2020 Page 1					
ID:DMCubINVR6TstFoa31v6I zns11-C5PDjM9sMmlc7uvCW4xuh70zVKRfg8t7 .s31zMEr					
Scale = 1:33.6					

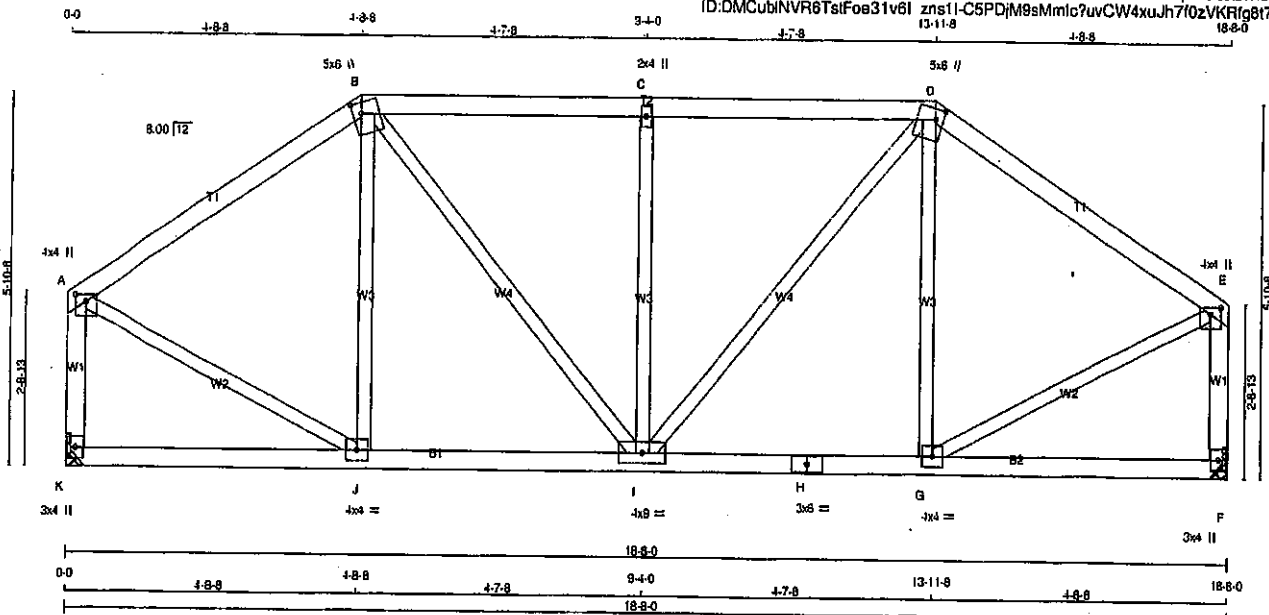

TOTAL WEIGHT = 83 lb

LUMBER	SIZE	LUMBER	DESCR.
N. L. G. A. RULES			
CHORDS			
A - B	2x4	DRY	No.2
B - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
K - A	2x4	DRY	No.2
F - E	2x4	DRY	No.2
K - H	2x4	DRY	No.2
H - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table/s in inches)

JT TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25 2.00
B	TTWW+m	MT20	5.0	8.0	2.00 1.50
C	TMVW+m	MT20	2.0	4.0	
D	TTWW+m	MT20	5.0	8.0	2.00 1.50
E	TMVW+p	MT20	4.0	4.0	1.25 2.00
F	BMV1+p	MT20	3.0	4.0	
G	BMVW-t	MT20	4.0	4.0	
H	BS-t	MT20	3.0	8.0	
I	BMVW-t	MT20	4.0	9.0	
J	BMVW-t	MT20	4.0	4.0	
K	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORIZ	UPLIFT
K	1029	0	1029	0
F	1029	0	1029	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT K, F. MINIMUM BEARING LENGTH AT JOINT K = 3-8, JOINT F = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS
	COMBINED	SNOW
K	728	478 / 0
F	728	478 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED	VERT. LOAD	FACTORED	MAX. FACTORED	WEBS	MEMB.	MAX. FACTORED	VERT. LOAD	FACTORED
		(LBS)	(PLF)	(LBS)	(LBS)			(LBS)	(LBS)	(LBS)
FR-TO						FR-TO				
A-B	-799.0	-91.8	-91.8	0.37 (1)	8.23	J-B	-231.0	0	0.12 (1)	
B-C	-905.0	-91.8	-91.8	0.34 (1)	5.99	B-I	0	0.384	0.09 (1)	
C-D	-905.0	-91.8	-91.8	0.34 (1)	5.99	I-C	-519.0	0	0.28 (1)	
D-E	-799.0	-91.8	-91.8	0.37 (1)	6.23	D-I	0	0.384	0.09 (1)	
K-A	-994.0	0.0	0.0	0.14 (1)	7.81	G-D	-231.0	0	0.12 (1)	
F-E	-994.0	0.0	0.0	0.14 (1)	7.81	A-J	0	0.743	0.17 (1)	
						G-E	0	0.743	0.17 (1)	
K-J	0.0	-18.5	-18.5	0.10 (4)	10.00					
J-I	0.680	-18.5	-18.5	0.17 (1)	10.00					
I-H	0.680	-18.5	-18.5	0.17 (1)	10.00					
H-G	0.680	-18.5	-18.5	0.17 (1)	10.00					
G-F	0.0	-18.5	-18.5	0.10 (4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.82")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.82")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.37/1.00 (A-B:1), BC=0.17/1.00 (I-J:1), WB=0.28/1.00 (C-I:1), SSI=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.79 (I) (INPUT = 0.90)
JSI METAL= 0.25 (J) (INPUT = 1.00)



Structural component only
DWG# T-2007703

JOB NAME 408267	TRUSS NAME T23	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 30 2019 Mtek Industries, Inc. Tue Apr 28 09:31:44 2020 Page 1
ID:DMCubINVR6TstF0e31v6l_zns11-glzbwIAU64QTc1UO4nS7svqTMqeA2Li6nkQbtZMEqz
17-11-8 152-5 18-8-0

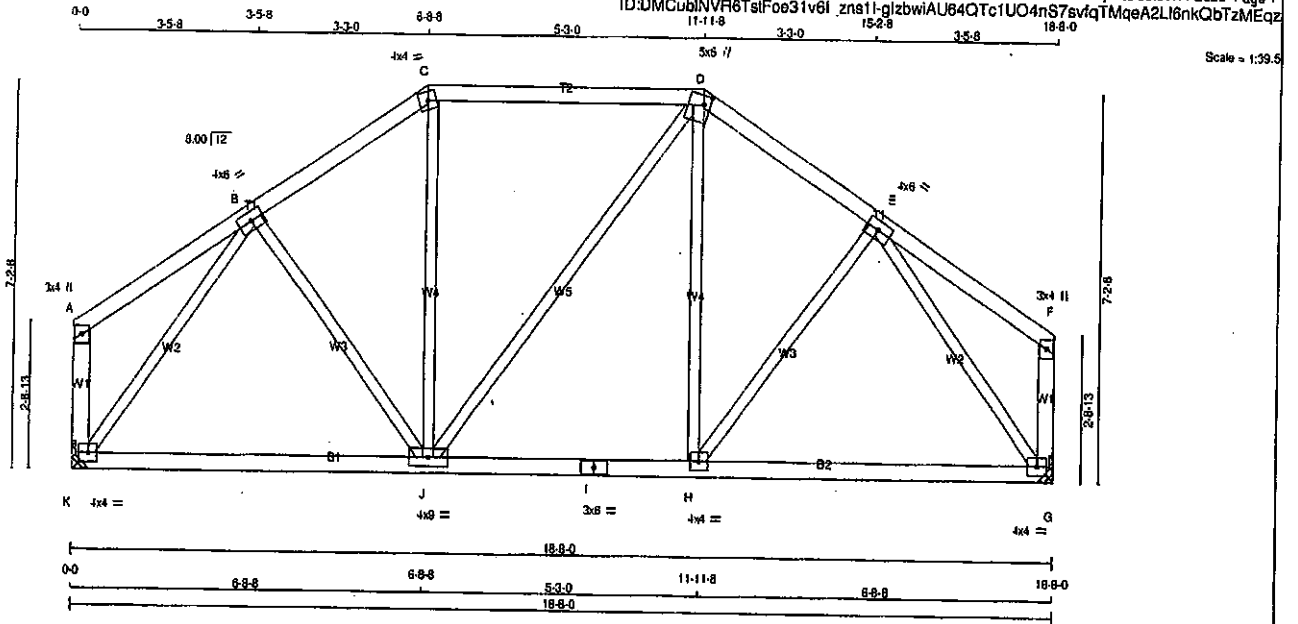

TOTAL WEIGHT = 86 lb (M/F)

LUMBER			
N. L. O. A. RULES	SIZE	DRY	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
K - A	2x4	DRY	No.2
G - F	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - G	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMV+p	MT20	3.0	4.0	
B	TMVW-t	MT20	4.0	6.0	
C	TTW-m	MT20	4.0	4.0	
D	TTWW+m	MT20	5.0	8.0	2.00 1.50
E	TMVW-t	MT20	4.0	6.0	
F	TMV+p	MT20	3.0	4.0	
G	BMVW-t	MT20	4.0	4.0	
H	BMVW-t	MT20	4.0	4.0	
I	BS-t	MT20	3.0	8.0	
J	BMVW-t	MT20	4.0	9.0	
K	BMVW-t	MT20	4.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG	
K	VERT	DOWN	UP	IN-SX	IN-SX
G	1029 0	1029 0	0	MECHANICAL	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT K, G. MINIMUM BEARING LENGTH AT JOINT K = 3-8, JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS					
K	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
G	728	478 / 0	0 / 0	0 / 0	0 / 0	250 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED	MEMB.	MAX. FACTORED
	FORCE (LBS)		FORCE (LBS)
FR-TO		FR-TO	
A-B	0 - 19	B-J	0 58
B-C	-803 0	J-C	0 87
C-D	-651 0	J-D	0 0
D-E	-802 0	H-D	0 87
E-F	0 - 19	H-E	0 58
K-A	-120 0	K-B	-1058 0
G-F	-120 0	E-G	-1058 0
K-J	0 619		
J-I	0 651		
I-H	0 651		
H-G	0 619		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.62")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.62")
CALCULATED VERT. DEFL.(TL) = L/999 (0.08")

CSI: TC=0.33/1.00 (C-D:1), BC=0.22/1.00 (G-H:4), WB=0.57/1.00 (B-K:1), SS=0.19/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	616	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.81 (K) (INPUT = 0.90)
JSI METAL = 0.25 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007704

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408267	T26	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:31:45 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-8UWz72A6iOYKEB3oeVzMP6C_EmBiv66RKRTz7wzMEqy

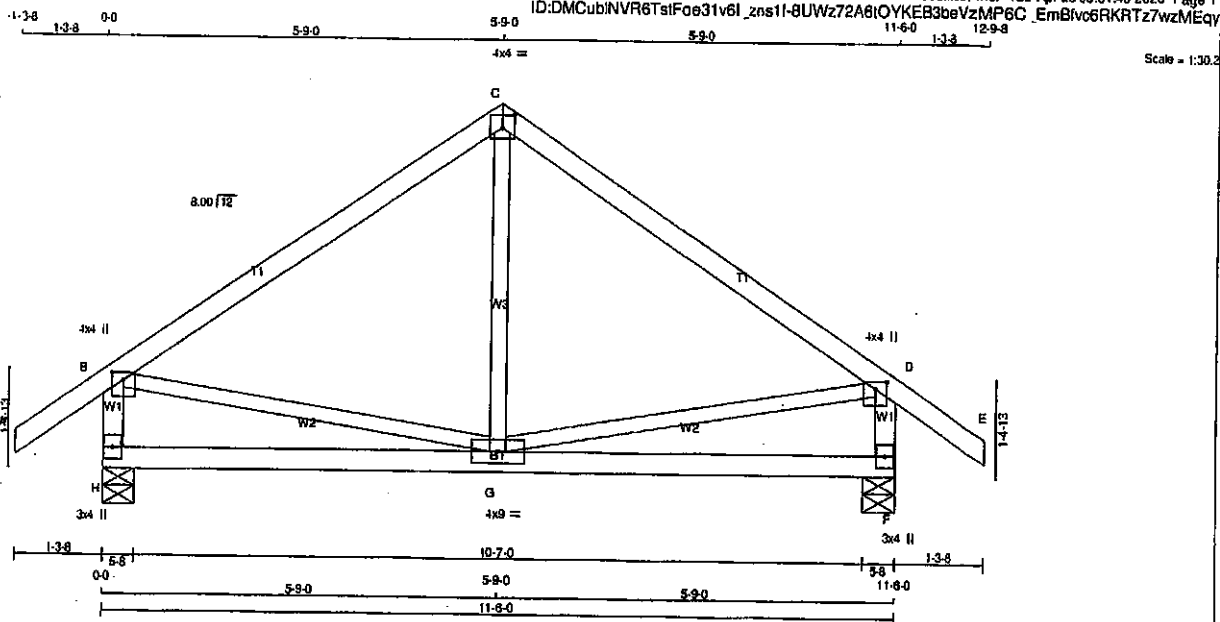

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
F - D	2x4	DRY	No.2
H - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMW+p	MT20	4.0	4.0	1.25 2.00
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TMW+p	MT20	4.0	4.0	1.25 2.00
F	BMV1+p	MT20	3.0	4.0	
G	BMVWW-1	MT20	4.0	3.0	
H	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	UP	BRG	BRG	IN-SX	IN-SX
H	780	0	780	0	0	5-8	5-8		
F	780	0	780	0	0	5-8	5-8		

UNFACTORED REACTIONS		1ST LCASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
H	535	384.0	0.0	0.0	0.0
F	535	384.0	0.0	0.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	FORCE (LBS)	VERT. LOAD (PL)	MAX. (LC)	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	FR-TO	
A-B	0.35	-91.8	-91.8 0.12 (1)	G-C	-14.94
B-C	-483.0	-91.8	-91.8 0.39 (1)	B-G	0.392
C-D	-483.0	-91.8	-91.8 0.39 (1)	G-D	0.392
D-E	0.35	-91.8	-91.8 0.12 (1)		
H-B	-719.0	0.0	0.0 0.07 (1)		
F-D	-719.0	0.0	0.0 0.07 (1)		
H-G	0.0	-18.5	-18.5 0.17 (4)		
G-F	0.0	-18.5	-18.5 0.17 (4)		

TOTAL WEIGHT = 2 X 48 = 96 lb

DESIGN CRITERIA

SPECIFIED LOADS:	
TOP CH.	LL = 25.6 PSF
BOT CH.	LL = 6.0 PSF
	DL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. O/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.38")
CALCULATED VERT. DEFL. (LL) = $L/989$ (0.01")
ALLOWABLE DEFL. (YL) = $L/360$ (0.38")
CALCULATED VERT. DEFL. (YL) = $L/989$ (0.03")

CSI: TC=0.39/1.00 (C-D:1), BC=0.17/1.00 (F-G:4), WB=0.09/1.00 (D-G:1), SS=0.17/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	618	354	1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.55 (D) (INPUT = 0.90)
JSI METAL= 0.10 (D) (INPUT = 1.00)




Structural component only
DWG# T-2007705

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408267	G26	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri May 8 12:57:36 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-dzBZSOP0g1AxOmdGvs1ZqxMxY1?bmez_b_qNcvzIZnz

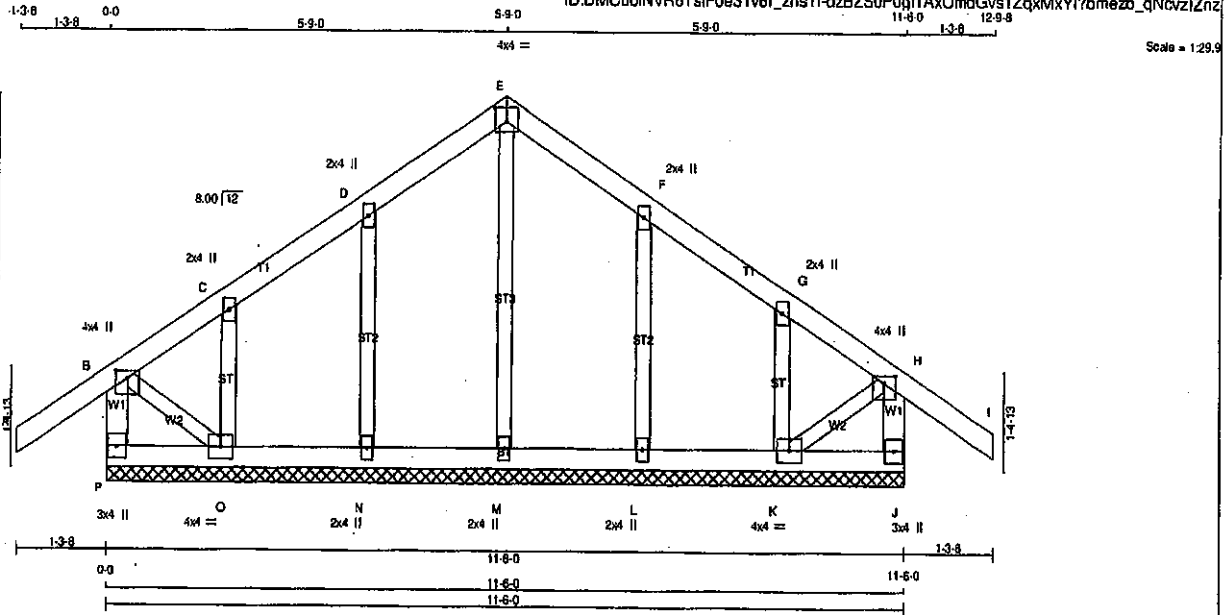

TOTAL WEIGHT = 50 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
P - B	2x4	DRY	No.2	SPF	
A - E	2x4	DRY	No.2	SPF	
E - I	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
P - J	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
ALL GABLE WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

GABLE STUDS SPACED AT 2'-0\"

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER
BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMWV+p	MT20	4.0	4.0	1.25	2.00
C, D, F, G						
C	TMWV+w	MT20	2.0	4.0		
E	TTW+p	MT20	4.0	4.0	2.25	2.00
H	TMWV+p	MT20	4.0	4.0	1.25	2.00
J	BMV1+p	MT20	3.0	4.0		
K	BMWV1+1	MT20	4.0	4.0		
L, M, N						
L	BMWV1+w	MT20	2.0	4.0		
O	BMWV1+1	MT20	4.0	4.0		
P	BMV1+p	MT20	3.0	4.0		

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)	MAX. FACTORED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)
P-B	-268 / 0	0.0	0.0	0.03 (1)	7.81	M-E	-141 / 0	0.08 (1)	
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	N-D	-222 / 0	0.05 (1)	
B-C	-44 / 0	-91.8	-91.8	0.12 (1)	6.25	O-C	-103 / 0	0.02 (1)	
C-D	-5 / 0	-91.8	-91.8	0.08 (1)	10.00	L-F	-222 / 0	0.05 (1)	
D-E	-19 / 0	-91.8	-91.8	0.08 (1)	6.25	K-G	-103 / 0	0.02 (1)	
E-F	-19 / 0	-91.8	-91.8	0.08 (1)	6.25	B-O	0 / 18	0.00 (1)	
F-G	-5 / 0	-91.8	-91.8	0.08 (1)	10.00	K-H	0 / 18	0.00 (1)	
G-H	-44 / 0	-91.8	-91.8	0.12 (1)	8.25				
H-I	0 / 35	-91.8	-91.8	0.12 (1)	10.00				
J-H	-268 / 0	0.0	0.0	0.03 (1)	7.81				
P-O	0 / 6	-18.5	-18.5	0.02 (4)	10.00				
O-N	0 / 11	-18.5	-18.5	0.02 (4)	10.00				
N-M	0 / 6	-18.5	-18.5	0.01 (4)	10.00				
M-L	0 / 6	-18.5	-18.5	0.01 (4)	10.00				
L-K	0 / 11	-18.5	-18.5	0.02 (4)	10.00				
K-J	0 / 0	-18.5	-18.5	0.02 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.
(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (H-E), BC=0.02/1.00 (K-L),
WB=0.08/1.00 (E-M), SSI=0.08/1.00 (H-E)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.19 (B) (INPUT = 0.90)
JSI METAL = 0.11 (D) (INPUT = 1.00)



Structural component only
DWG# T-2008523

JOB NAME 408267	TRUSS NAME T27	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:31:46 2020 Page 2 ID:DMCubNVR6TsiFee31v6I zns11-cq4LL08khhAsLenBCVbxKI66ANPay7bZ5DXiMzMEox	

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
C	TMVW-1	MT20	5.0	6.0	2.25	2.25
D	BMV1+p	MT20	3.0	6.0		
E	BMVWW-1	MT20	8.0	9.0		
F	BMV1+p	MT20	3.0	8.0		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
T	9-11-4	-25	-25	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007706 2/2

JOB NAME 408268	TRUSS NAME T30	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:54:30 2020 Page 2
ID:DMCubINVR8TstFoe31v6l zns1l-g5V?enIKQnXeVzvx5qzSDzEBY0vsDoIMDIdlYfzMEVd

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	9.0	1.00	4.75
C	TTWW+m	MT20	5.0	8.0	Edge	
D	TMWW-t	MT20	5.0	8.0	2.50	2.75
E	TMW+w	MT20	3.0	6.0		
F	TMWW-t	MT20	5.0	6.0		
G	TMW+w	MT20	3.0	6.0		
H	TS-t	MT20	5.0	8.0		
I	TMWW-t	MT20	5.0	6.0	2.50	2.75
J	TTWW+m	MT20	5.0	8.0	Edge	
K	TMVW-p	MT20	4.0	9.0	1.00	4.75
M	BMV1-p	MT20	3.0	6.0		
N	BMWW-t	MT20	5.0	8.0	2.50	3.75
O	BMWW-t	MT20	5.0	8.0	2.50	2.00
P	BS-t	MT20	5.0	6.0		
Q	BMWWW-t	MT20	7.0	8.0	4.25	2.25
R	BMWWW-t	MT20	7.0	8.0	4.25	3.25
S	BS-t	MT20	5.0	6.0		
T	BMWW-t	MT20	5.0	6.0	2.50	2.00
U	BMWW-t	MT20	5.0	8.0	2.50	3.75
V	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
Y	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	19-8-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AB	21-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AC	25-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AD	27-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AE	31-1-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AF	33-1-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007713 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408268	T30Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:54:31 2020 Page 2
 ID:DMCubINVR6TslFoe31v6I zns1I-9H3Nq7IvB5IV66U7INUmAnLaPHOvEBVSyNG4kzMEVc

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	2.00	3.50
C	TTWW+m	MT20	5.0	8.0	Edge	
D, F, I						
D	TMVW-l	MT20	5.0	8.0		
E	TMVW+w	MT20	3.0	8.0		
G	TMVW+w	MT20	3.0	8.0		
H	TS-l	MT20	5.0	8.0		
J	TTWW+m	MT20	5.0	8.0	Edge	
K	TMVW-p	MT20	5.0	8.0	2.00	3.50
M	BMV1-p	MT20	3.0	8.0		
N	BMVW-l	MT20	5.0	8.0	2.50	3.50
O	BMVW-l	MT20	5.0	8.0	4.25	2.25
P	BS-l	MT20	5.0	8.0		
Q	BMVWW-l	MT20	5.0	8.0		
R	BMVWW-l	MT20	5.0	8.0		
S	BS-l	MT20	5.0	8.0		
T	BMVW-l	MT20	5.0	8.0	4.25	2.25
U	BMVW-l	MT20	5.0	8.0	2.50	3.50
V	BMV1-p	MT20	3.0	8.0		

CONNECTION REQUIREMENTS


1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.



Structural component only
 DWG# T-2007714 7/2

JOB NAME 408268	TRUSS NAME T31	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:54:32 2020 Page 1	
ID:DMCubINVR6TstFoe31v6l zns1i-dTdtITJayOnMkG3JD5?wINJTApC8hh /gc6pcBzMEVb				20-9-7 27-9-8 31-1-8 35-2-0 35-5-8 1-3-8	
Scale = 1:57.6					

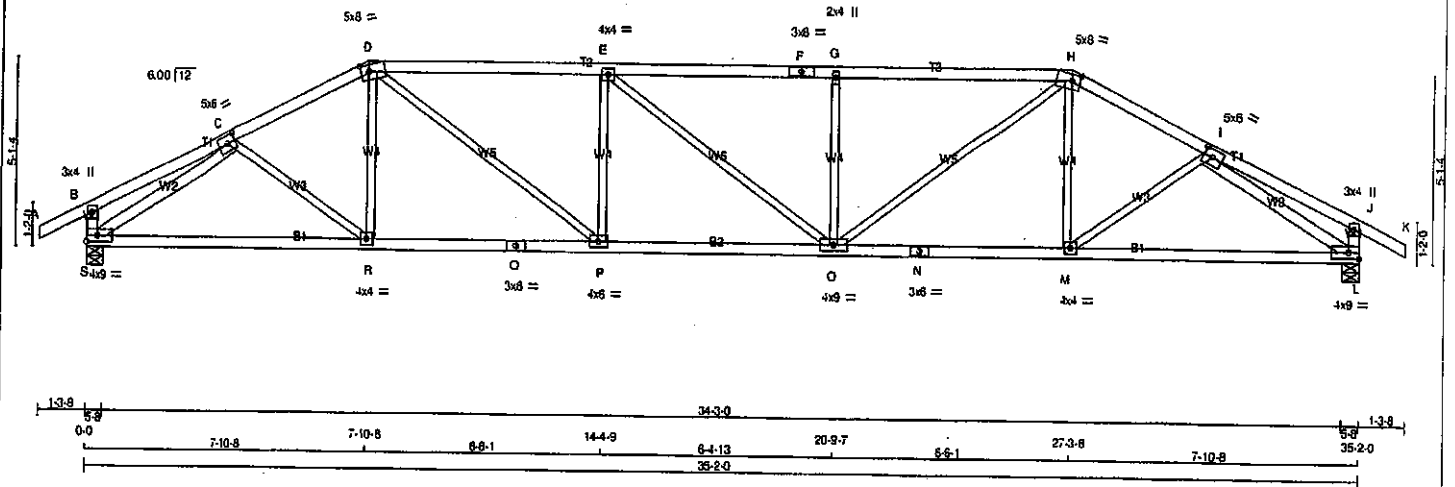

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMV-p	MT20	3.0	4.0
C	TMVW-1	MT20	5.0	6.0 2.50 2.75
D	TTVW-m	MT20	5.0	8.0 2.25 2.75
E	TMVW-1	MT20	4.0	4.0
F	TS-1	MT20	3.0	8.0
G	TMVW-w	MT20	2.0	4.0
H	TTVW-m	MT20	5.0	8.0 2.25 2.75
I	TMVW-1	MT20	5.0	6.0 2.50 2.75
J	TMV-p	MT20	3.0	4.0
L	BMVW1-1	MT20	4.0	9.0 Edge
M	BMVW-1	MT20	4.0	4.0
N	BS-1	MT20	3.0	6.0
O	BMVW-1	MT20	4.0	9.0
P	BMVW-1	MT20	4.0	6.0
Q	BS-1	MT20	3.0	6.0
R	BMVW-1	MT20	4.0	4.0
S	BMVW1-1	MT20	4.0	9.0 Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
	FACTORED	MAXIMUM FACTORED	INPUT
	GROSS REACTION	GROSS REACTION	BRG
JT	VERT	DOWN	HORIZ
S	2063	0	2063
L	2063	0	2063

UNFACTORED REACTIONS			
	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	
	COMBINED	SNOW	LIVE
JT	1457	968.7	0.0
L	1457	968.7	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.94 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)
FR-TO			
A-B	0.28	-91.8	10.00
B-C	0.16	-91.8	10.00
C-D	-2799.0	-91.8	10.00
D-E	-3508.0	-91.8	10.00
E-F	-3507.0	-91.8	10.00
F-G	-3507.0	-91.8	10.00
G-H	-3507.0	-91.8	10.00
H-I	-2799.0	-91.8	10.00
I-J	0.16	-91.8	10.00
J-K	0.28	-91.8	10.00
S-B	-270.0	0.0	10.00
L-J	-270.0	0.0	10.00
S-R	0.2417	-18.5	10.00
R-Q	0.2489	-18.5	10.00
Q-P	0.2489	-18.5	10.00
P-O	0.3509	-18.5	10.00
O-N	0.2489	-18.5	10.00
N-M	0.2489	-18.5	10.00
M-L	0.2417	-18.5	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.21')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.41')

CSI: TC=0.95/1.00 (D-E:1), BC=0.64/1.00 (O-P:1), WB=0.83/1.00 (H-L:1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 918 354 1887 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (L) (INPUT = 0.90)
JSI METAL = 0.77 (N) (INPUT = 1.00)



Structural component only
DWG# T-2007715

JOB NAME 408268	TRUSS NAME T32	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 5 Oct 2019 Mitek Industries, Inc. Tue Apr 28 09:54:33 2020 Page 1	
ID:DMCubNVR6TstFoe31v8l_zns1l-5gB7FpkCjvDMQeWnoW9rbsdwD7WQB2ovGsM8dzMEVa				35-20 36-8 1-3-8 Scale = 1:57.6	

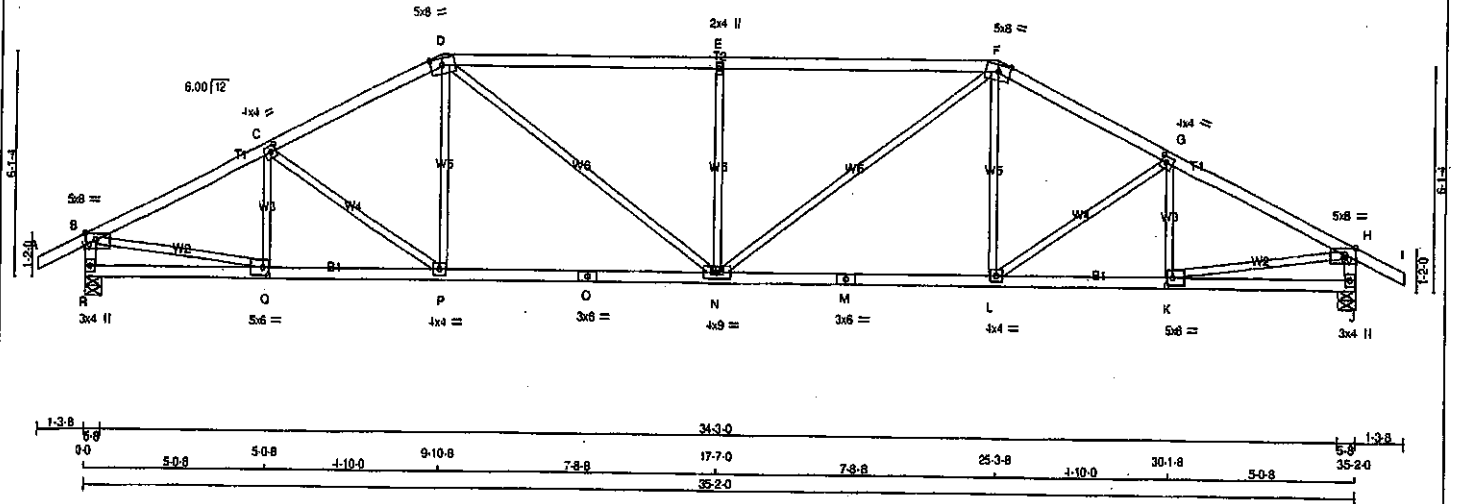

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2
H - G	2x4	DRY	No.2
G - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			SPF
DRY: SEASONED LUMBER.			

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMWW-p	MT20	5.0	8.0 Edge 3.50
C	TMWW-i	MT20	4.0	4.0 2.00 1.75
D	TTWW-m	MT20	5.0	8.0 2.25 3.75
E	TMWW-w	MT20	2.0	4.0
F	TTWW-m	MT20	5.0	8.0 2.25 3.75
G	TMWW-i	MT20	4.0	4.0 2.00 1.75
H	TMWW-p	MT20	5.0	8.0 Edge 3.50
J	BMV1-p	MT20	3.0	4.0
K	BMWW-i	MT20	5.0	8.0 2.50 2.00
L	BMWW-i	MT20	4.0	4.0
M	BS-i	MT20	3.0	6.0
N	BMWW-i	MT20	4.0	9.0
O	BS-i	MT20	3.0	6.0
P	BMWW-i	MT20	4.0	4.0
Q	BMWW-i	MT20	5.0	8.0 2.50 2.00
R	BMV1-p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	UPLIFT	BRG	BRG	IN-SX
R	2083	0	0	2083	0	0	5-8	5-8	5-8
J	2083	0	0	2083	0	0	5-8	5-8	5-8
UNFACTORED REACTIONS		1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
R	1457	969 / 0	0 / 0	0 / 0	0 / 0	488	0	0 / 0	0 / 0
J	1457	969 / 0	0 / 0	0 / 0	0 / 0	488	0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.78 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PL)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO				FR-TO			
A-B	0 28	-91.8	-91.8 0.12 (1)	Q-C	-353 0	0.08 (1)	
B-C	-2834 0	-91.8	-91.8 0.39 (1)	C-P	-210 0	0.13 (1)	
C-D	-2887 0	-91.8	-91.8 0.37 (1)	P-O	0 246	0.08 (4)	
D-E	-3060 0	-91.8	-91.8 0.97 (1)	D-N	0 844	0.19 (1)	
E-F	-3060 0	-91.8	-91.8 0.97 (1)	N-E	-872 0	0.51 (1)	
F-G	-2887 0	-91.8	-91.8 0.37 (1)	E-F	0 844	0.19 (1)	
G-H	-2834 0	-91.8	-91.8 0.39 (1)	L-F	0 246	0.08 (4)	
H-I	0 28	-91.8	-91.8 0.12 (1)	L-G	-210 0	0.13 (1)	
R-B	-2018 0	0.0	0.0 0.20 (1)	K-B	-353 0	0.08 (1)	
J-H	-2018 0	0.0	0.0 0.20 (1)	B-Q	0 2591	0.58 (1)	
R-Q	0 0	-18.5	-18.5 0.10 (4)	K-H	0 2591	0.58 (1)	
Q-P	0 2555	-18.5	-18.5 0.51 (1)				
P-O	0 2386	-18.5	-18.5 0.49 (1)				
O-N	0 2386	-18.5	-18.5 0.49 (1)				
N-M	0 2386	-18.5	-18.5 0.49 (1)				
M-L	0 2386	-18.5	-18.5 0.49 (1)				
L-K	0 2555	-18.5	-18.5 0.51 (1)				
K-J	0 0	-18.5	-18.5 0.10 (4)				

TOTAL WEIGHT = 2 X 139 = 277 lb [M](F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN GC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/999 (0.17")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/999 (0.34")

CSI: TC=0.97/1.00 (D-E:1), BC=0.51/1.00 (K-L:1), WB=0.58/1.00 (H-K:1), SS=0.34/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.87 (D) (INPUT = 0.90)
JSI METAL = 0.82 (M) (INPUT = 1.00)

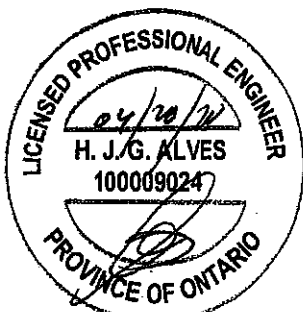

Structural component only
DWG# T-2007716

JOB NAME 408268	TRUSS NAME T33	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TAMERACK ROOF TRUSS, BURLINGTON					

Version 8.310 5 Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:54:34 2020 Page 1
ID:DMCubINVR6TsIF0831v6I_zns11-ZsiWS9iU0142aDiKW100oPtdL09e8y8vbwH3zMEVZ
23-9-8 29-1-8 35-2-0 35-5-8
Scale = 1:57.6

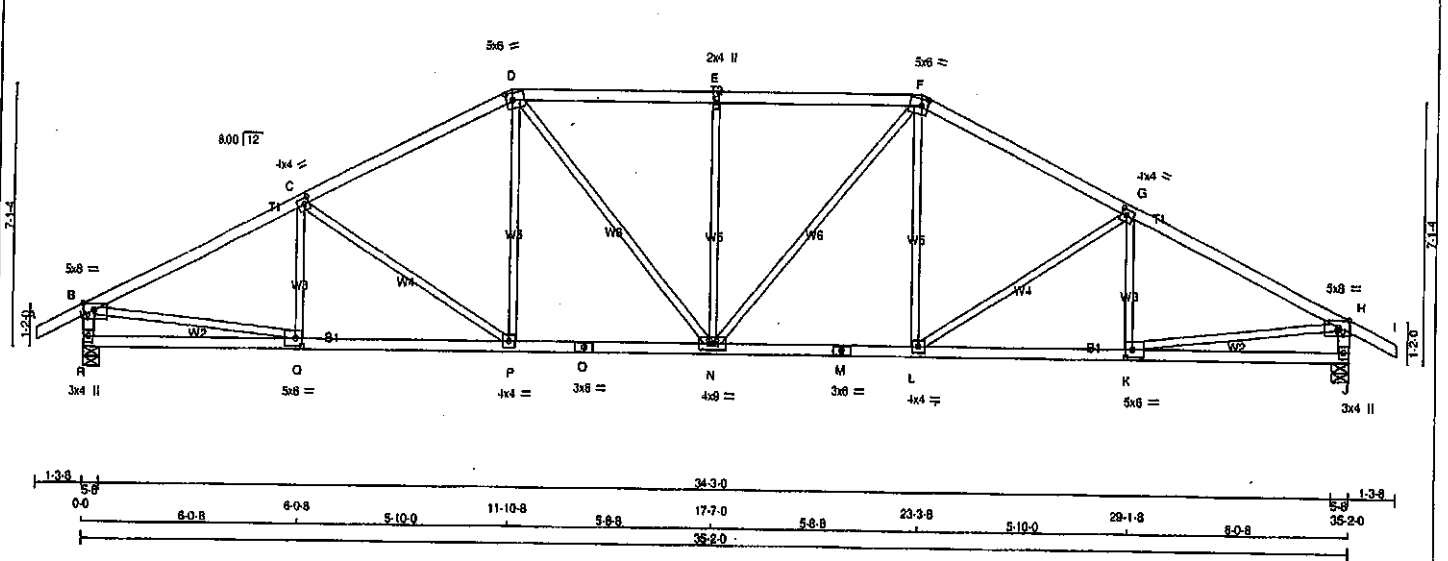

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
J - K	2x4	DRY	No.2
K - N	2x4	DRY	No.2
N - O	2x4	DRY	No.2
O - P	2x4	DRY	No.2
P - Q	2x4	DRY	No.2
Q - R	2x4	DRY	No.2
R - S	2x4	DRY	No.2
S - T	2x4	DRY	No.2
T - U	2x4	DRY	No.2
U - V	2x4	DRY	No.2
V - W	2x4	DRY	No.2
W - X	2x4	DRY	No.2
X - Y	2x4	DRY	No.2
Y - Z	2x4	DRY	No.2
Z - A	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	8.0	Edge 3.50
C	TMVW-t	MT20	4.0	4.0	2.00 1.75
D	TTWW-m	MT20	5.0	6.0	2.25 2.00
E	TMVW-w	MT20	2.0	4.0	
F	TTWW-m	MT20	5.0	6.0	2.25 2.00
G	TMVW-t	MT20	4.0	4.0	2.00 1.75
H	TMVW-p	MT20	5.0	8.0	Edge 3.50
J	BMV1-p	MT20	3.0	4.0	
K	BMVW-t	MT20	5.0	6.0	2.50 2.25
L	BMVW-t	MT20	4.0	4.0	
M	BS-t	MT20	3.0	6.0	
N	BMVW-t	MT20	4.0	4.0	
O	BS-t	MT20	3.0	6.0	
P	BMVW-t	MT20	4.0	4.0	
Q	BMVW-t	MT20	5.0	6.0	2.50 2.25
R	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
R	2063	0	2063	0	5-8
J	2063	0	2063	0	5-8

UNFACTORED REACTIONS		1ST CASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
R	1457	989.0	0.0
J	1457	989.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)		CHORDS	FACTORED	WEBS	FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PL)	MAX. (CSI (LC))	MEMB.	FORCE (LBS)
FR-TO				FR-TO	
A-B	0.28	-91.8	-91.8 0.12 (1)	Q-C	-255 12
B-C	-2889.0	-91.8	-91.8 0.58 (1)	G-P	-435.0
C-D	-2539.0	-91.8	-91.8 0.52 (1)	P-D	0.350
D-E	-2559.0	-91.8	-91.8 0.48 (1)	D-N	0.482
E-F	-2559.0	-91.8	-91.8 0.48 (1)	N-E	-841.0
F-G	-2539.0	-91.8	-91.8 0.52 (1)	N-F	0.482
G-H	-2889.0	-91.8	-91.8 0.58 (1)	L-F	0.350
H-I	0.28	-91.8	-91.8 0.12 (1)	L-G	-435.0
R-B	-2014.0	0.0	0.0 0.20 (1)	K-G	-255 12
J-H	-2014.0	0.0	0.0 0.20 (1)	B-Q	0.2635
R-Q	0.0	-18.5	-18.5 0.15 (4)	K-H	0.2635
Q-P	0.2809	-18.5	-18.5 0.49 (1)		
P-O	0.2249	-18.5	-18.5 0.43 (1)		
O-N	0.2249	-18.5	-18.5 0.43 (1)		
N-M	0.2249	-18.5	-18.5 0.43 (1)		
M-L	0.2249	-18.5	-18.5 0.43 (1)		
L-K	0.2609	-18.5	-18.5 0.49 (1)		
K-J	0.0	-18.5	-18.5 0.15 (4)		

TOTAL WEIGHT = 2 X 145 = 289 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/989 (0.15")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/989 (0.28")

CSI: TC=0.58/1.00 (G-H:1), BC=0.49/1.00 (K-L:1), WB=0.59/1.00 (H-K:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1987 1656



PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (Q) (INPUT = 0.90)
JSI METAL = 0.69 (M) (INPUT = 1.00)



Structural component only
DWG# T-2007717

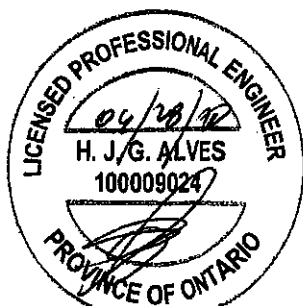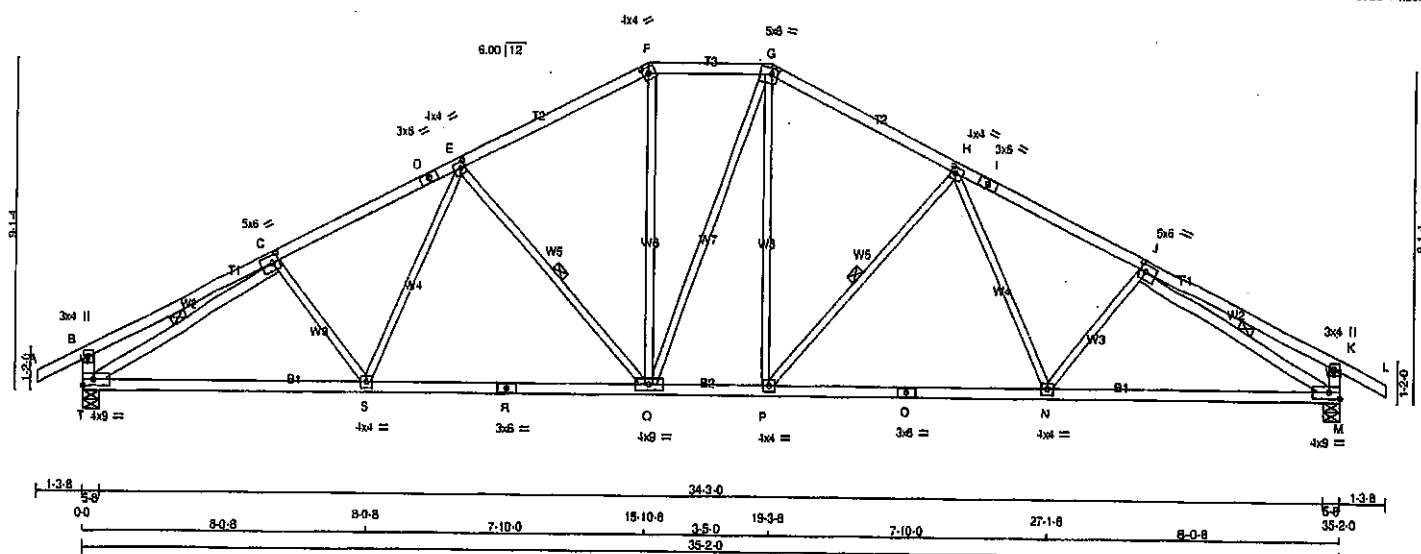

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408268	T37	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Tue Apr 28 09:54:39 2020 Page 2
 ID:OMCubINVR6TsiFoe31v6I zns1l-wpYPVspzYIM4L5f73dZ5s6gqe1lq w hHCJhMhZMEVL

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
V	16-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
 DWG# T-2007721 72

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408268	T38	1	1	GREEN PARK HOMES	
TAMARACK ROOF TRUSS, BURLINGTON					

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:54:40 2020 Page 1
ID:DMCubINVR6TsIFoe31v6l_zns11-008nCpb3soDhVqsh80d37q1R6Z0BqWs2EujzMEVT
1-3-8 1-3-8 0-0 3-9-8 3-9-8 3-7-0 7-4-8 4-3-0 11-7-8 3-7-0 15-2-8 3-9-8 1-3-8 20-3-8
Scale = 1:32.0

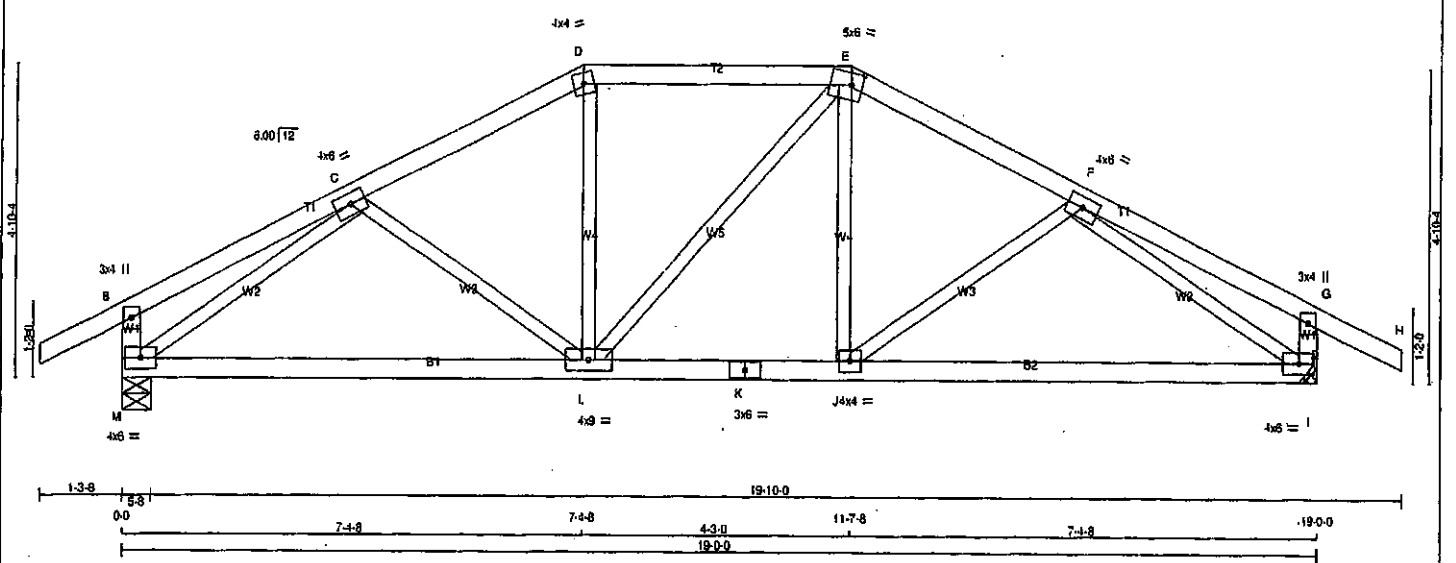

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - H	2x4	DRY	No.2
M - B	2x4	DRY	No.2
I - G	2x4	DRY	No.2
M - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)				
JT	TYPE	PLATES	W	LEN Y X
9	TMV-p	MT20	3.0	4.0
C	TMVW-1	MT20	4.0	8.0
D	TTW-m	MT20	4.0	4.0
E	TTWW-m	MT20	5.0	8.0
F	TMVW-1	MT20	3.0	4.0
G	TMV-p	MT20	3.0	4.0
I	BMVW-1	MT20	4.0	8.0
J	BMVW-1	MT20	4.0	4.0
K	BS-1	MT20	3.0	8.0
L	BMVWV-1	MT20	4.0	9.0
M	BMVW-1	MT20	4.0	6.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
M	1172	0	1172	0	0	5-8	5-8		
I	1172	0	1172	0	0	MECHANICAL			

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
M	828	556	0	0	0	271	0
I	828	556	0	0	0	271	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.89 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. UNBRACED LENGTH (FT)
FR-TO				FR-TO			
A-B	0 28	-91.8	-91.8 0.12 (1)	10.00	C-L	-144 10	0.05 (1)
B-C	0 16	-91.8	-91.8 0.18 (1)	10.00	L-D	0 200	0.05 (1)
C-D	-1192 0	-91.8	-91.8 0.16 (1)	5.89	L-E	0 0	0.00 (1)
D-E	-1055 0	-91.8	-91.8 0.23 (1)	5.87	J-E	0 200	0.05 (1)
E-F	-1191 0	-91.8	-91.8 0.16 (1)	5.89	J-F	-144 10	0.05 (1)
F-G	0 16	-91.8	-91.8 0.18 (1)	10.00	M-C	-1447 0	0.49 (1)
G-H	0 28	-91.8	-91.8 0.12 (1)	10.00	F-I	-1448 0	0.49 (1)
M-B	-258 0	0 0	0.03 (1)	7.81			
I-G	-258 0	0 0	0.03 (1)	7.81			
M-L	0 1168	-18.5	-18.5 0.32 (1)	10.00			
L-K	0 1055	-18.5	-18.5 0.28 (4)	10.00			
K-J	0 1055	-18.5	-18.5 0.28 (4)	10.00			
J-I	0 1187	-18.5	-18.5 0.32 (1)	10.00			

TOTAL WEIGHT = 76 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:	
TOP CH.	LL = 25.6 PSF
DL	= 6.0 PSF
BOT CH.	LL = 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) =	L/360 (0.83")
CALCULATED VERT. DEFL.(LL) =	L/999 (0.04")
ALLOWABLE DEFL.(TL) =	L/360 (0.83")
CALCULATED VERT. DEFL.(TL) =	L/999 (0.13")

CSI: TC=0.23/1.00 (D-E-1), BC=0.32/1.00 (I-J-1),
WB=0.49/1.00 (C-M-1), SS=0.15/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION	(PSI)	(PLI)
				MAX	MIN
MT20	610	354	1687	788	1887

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.76 (M) (INPUT = 0.90)
JSI METAL = 0.40 (K) (INPUT = 1.00)

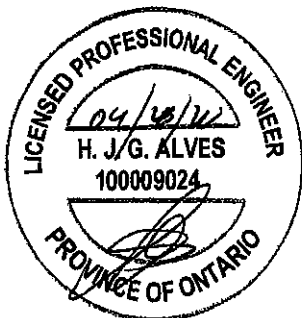

Structural component only
DWG# T-2007722

JOB NAME 408268	TRUSS NAME T39S	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:54:41 2020 Page 2
ID:DMCubINVR6TstFog31v6I_zns11-sCg9wYgEo9w4J/f2FUf1AH86MRkzlrn IWooQ9zMEVS


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	2.00	2.75
C	TTW-h	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	4.0	8.0		
E	TTWW-m	MT20	5.0	8.0	2.00	3.75
F	TMV-p	MT20	3.0	4.0		
G	TTWW-m	MT20	5.0	8.0	2.25	3.00
H	TMVW-p	MT20	5.0	6.0	2.00	3.00
I	BMV1-p	MT20	3.0	8.0	3.25	1.50
J	BMWW-t	MT20	5.0	6.0		
K	BVMWW-t	MT20	8.0	12.0	5.00	4.50
L	BMV-p	MT20	4.0	9.0	Edge	0.75
M	BMWW-t	MT20	6.0	9.0		
N	BS-t	MT20	5.0	6.0		
O	BVMWW-t	MT20	5.0	8.0	2.50	3.00
P	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.


CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER MECHANICAL CONNECTION IS REQUIRED.

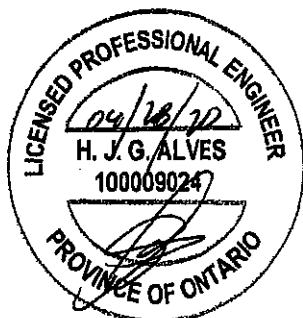

Structural component only
DWG# T-2007723 32

JOB NAME 408268	TRUSS NAME T40	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 8 Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:54:42 2020 Page 1 ID:DMCubINVR6TstFoe31v6l_zns11-KOEX8ursbT2xxpqEoBAGIUkQbr571Dx7zAXLzozMEVR	

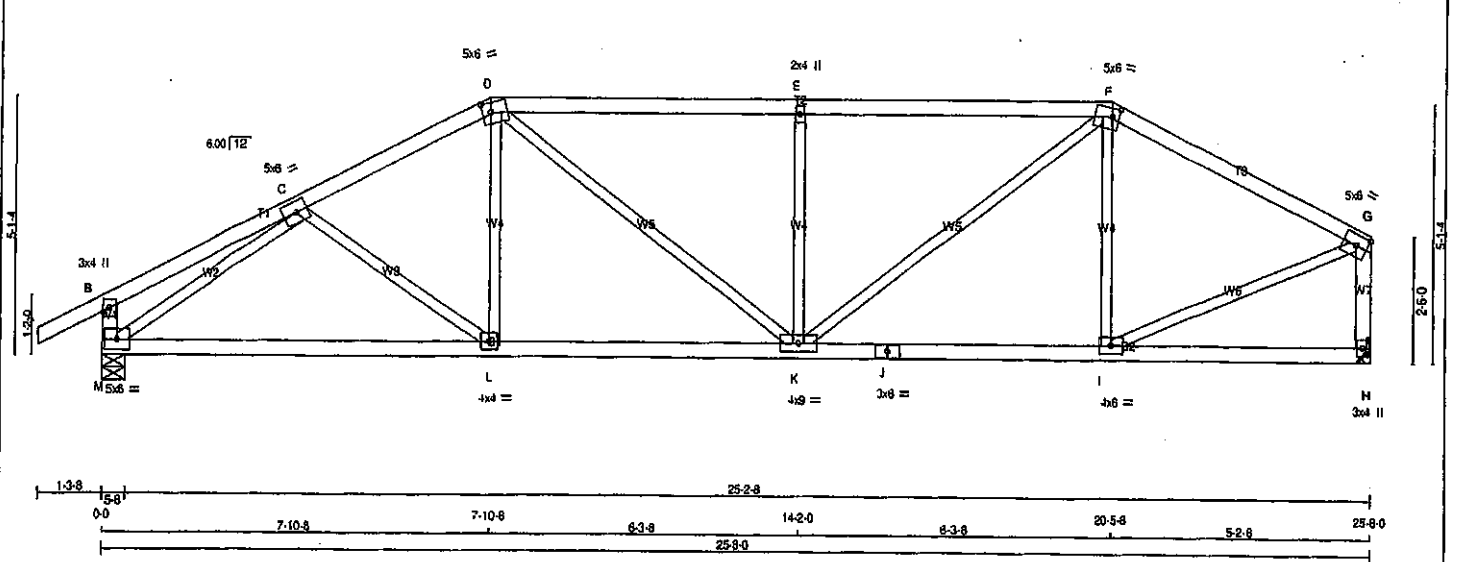

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
M - B	2x4	DRY	No.2
H - G	2x4	DRY	No.2
M - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV-p	MT20	3.0	4.0	
C	TMWW-t	MT20	5.0	6.0	
D	TTWW-m	MT20	5.0	6.0	2.25 2.00
E	TMWW-w	MT20	2.0	4.0	
F	TTWW-m	MT20	5.0	6.0	2.00 1.75
G	TMWW-t	MT20	5.0	6.0	Edge
H	BMV1-p	MT20	3.0	4.0	
I	BMWW-t	MT20	4.0	6.0	
J	BS-t	MT20	3.0	6.0	
K	BMWW-W-1	MT20	4.0	9.0	
L	BMWW-t	MT20	4.0	4.0	
M	BMWW-t	MT20	5.0	6.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	DOWN	UP	IN-SX
M 1539 0	1539 0	0	5-8
H 1415 0	1415 0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3'-8".

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
M	1088	728 0	0 0	0 0	380 0
H	1001	657 0	0 0	0 0	344 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.22 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)
FR-TO			
A-B	0 28	-91.8 -91.8	0.12 (1)
B-C	0 17	-91.8 -91.8	0.20 (1)
C-D	-1837 0	-91.8 -91.8	0.20 (1)
D-E	-1963 0	-91.8 -91.8	0.53 (1)
E-F	-1963 0	-91.8 -91.8	0.53 (1)
F-G	-1394 0	-91.8 -91.8	0.35 (1)
M-B	-288 0	0.0 0.0	0.03 (1)
H-G	-1378 0	0.0 0.0	0.18 (1)
M-L	0 1688	-18.5 -18.5	0.41 (1)
L-K	0 1631	-18.5 -18.5	0.40 (1)
K-J	0 1237	-18.5 -18.5	0.29 (1)
J-I	0 1237	-18.5 -18.5	0.29 (1)
I-H	0 0	-18.5 -18.5	0.15 (4)

WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO			
C-L	-75 39	0.03 (1)	
L-D	0 198	0.05 (4)	
D-K	0 419	0.09 (1)	
K-E	-711 0	0.27 (1)	
E-F	0 913	0.21 (1)	
F-G	-390 0	0.15 (1)	
M-C	-2077 0	0.80 (1)	
I-G	0 1348	0.30 (1)	

TOTAL WEIGHT = 100 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPI 2011, TPI 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.68")
CALCULATED VERT. DEFL. (LL) = L/999 (0.08")
ALLOWABLE DEFL. (TL) = L/360 (0.68")
CALCULATED VERT. DEFL. (TL) = L/999 (0.17")

CS1: TC=0.53/1.00 (D-E:1), BC=0.41/1.00 (L-M:1), WB=0.80/1.00 (C-A:1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP=0.88 (M) (INPUT = 0.90)
JSI METAL=0.60 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007724

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408268	T41	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:54:43 2020 Page 1
ID:DMCubINVR6TstFoe31v6I zns1I-obnvLEsUMnAoYyPRMvIVFHUPFSYmheGCqHuV2zMEVQ
1-3-8 0-0 5-0-8 5-0-8 1-10-2 9-10-8 1-3-8 14-2-0 18-5-8 3-8-0 21-11-8 3-8-8 25-8-0
Scale = 1:41.8

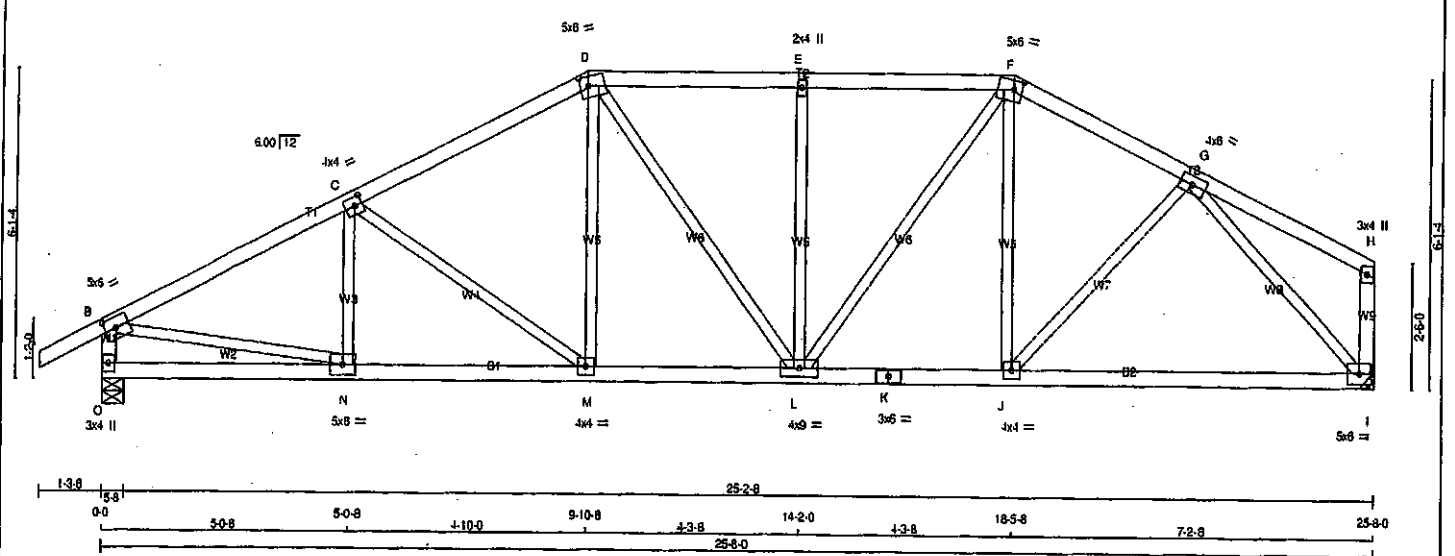

CHORDS	SIZE	LUMBER
A - D	2x4	DRY No.2
D - F	2x4	DRY No.2
F - H	2x4	DRY No.2
O - B	2x4	DRY No.2
I - H	2x4	DRY No.2
O - K	2x4	DRY No.2
K - I	2x4	DRY No.2
ALL WEBS	2x3	DRY No.2
EXCEPT		

DRY: SEASONED LUMBER.

PLATES (table in inches)	W	LEN	Y	X
JT TYPE	MT20	5.0	8.0	2.50 2.75
B TMWW-1	MT20	4.0	4.0	2.00 1.75
C TMWW-1	MT20	5.0	8.0	2.25 2.00
D TTWW-m	MT20	2.0	4.0	
E TMW-w	MT20	5.0	8.0	2.25 2.00
F TTWW-m	MT20	4.0	4.0	
G TMWW-1	MT20	3.0	4.0	
H TMV-p	MT20	5.0	8.0	
I BMWW-1	MT20	4.0	4.0	
J BMWW-1	MT20	3.0	6.0	
K BS-1	MT20	4.0	9.0	
L BMWW-1	MT20	4.0	4.0	
M BMWW-1	MT20	5.0	8.0	
N BMWW-1	MT20	3.0	4.0	
O BMV-1	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT ORG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
O	1539	0	1539	0
I	1415	0	1415	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3-8.

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	SNOW	LIVE
O	1086	728.0
I	1001	657.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.50 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	UNBRAC LENGTH	MEMB. FORCE (LBS)	MAX. FACTORED CS1 (LC)
FR-TO						
A-B	0.28	-91.8	-91.8	0.12 (1)	10.00	N-C
B-C	-1968.0	-91.8	-91.8	0.33 (1)	4.50	C-M
C-D	-1683.0	-91.8	-91.8	0.31 (1)	4.81	M-D
D-E	-1579.0	-91.8	-91.8	0.24 (1)	5.02	D-L
E-F	-1579.0	-91.8	-91.8	0.24 (1)	5.02	L-E
F-G	-1449.0	-91.8	-91.8	0.16 (1)	5.28	L-F
G-H	0.16	-91.8	-91.8	0.18 (1)	10.00	J-F
O-B	-1498.0	0.0	0.0	0.15 (1)	6.70	J-G
I-H	-129.0	0.0	0.0	0.02 (1)	7.81	B-N
O-N	0.0	-18.5	-18.5	0.10 (4)	10.00	G-I
N-M	0.1780	-18.5	-18.5	0.33 (1)	10.00	
M-L	0.1488	-18.5	-18.5	0.29 (1)	10.00	
L-K	0.1280	-18.5	-18.5	0.32 (1)	10.00	
K-J	0.1280	-18.5	-18.5	0.32 (1)	10.00	
J-I	0.1110	-18.5	-18.5	0.30 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.86")
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
ALLOWABLE DEFL.(TL) = L/360 (0.86")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CS1: TC=0.33/1.00 (B-C:1), BC=0.33/1.00 (M-N:1), WB=0.77/1.00 (G-I:1), SS=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP (DRY)	SHEAR (PL)	SECTION (PL)
	(PS)	(PL)	(PL)
	MAX	MIN	MAX
MT20	618	354	1687


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (G) (INPUT = 0.80)
JSI METAL = 0.53 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007725

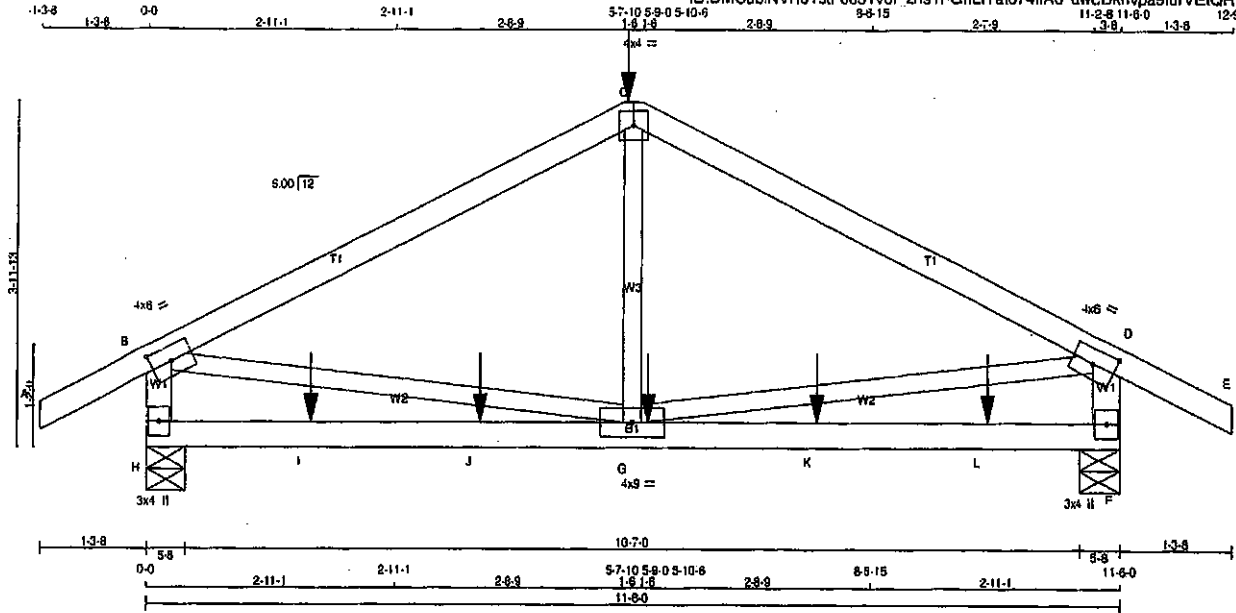

LUMBER

N.L.G.A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
F - D	2x4	DRY	No.2
H - F	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	6.0	2.00	3.00
C	TTW-p	MT20	4.0	4.0		
D	TMVW-1	MT20	4.0	6.0	2.00	3.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-1	MT20	4.0	9.0		
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REORD BRG
JT	VERT	HORIZ	UPLIFT	IN-SX
H	1108	0	1108	0
F	1110	0	1110	0

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS	DEAD	SOIL
JT	COMBINED		
H	780	533.0	0.0
F	782	533.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.91 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED COMB. (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED COMB. (LBS)	
FR-TO		FROM TO		FR-TO			
A-B	0 28	-91.8 -91.8 0.13 (1)	10.00	B-G	0 1037	0.28 (1)	
B-C	-1146 0	-91.8 -91.8 0.65 (1)	4.91	G-D	0 1037	0.28 (1)	
C-D	-1146 0	-91.8 -91.8 0.65 (1)	4.91	G-C	-117 118	0.04 (4)	
D-E	0 28	-91.8 -91.8 0.13 (1)	10.00				
H-B	-1054 0	0.0 0.0 0.12 (1)	7.63				
F-D	-1054 0	0.0 0.0 0.12 (1)	7.63				
H-I	0 0	-18.5 -18.5 0.27 (4)	10.00				
I-J	0 0	-18.5 -18.5 0.27 (4)	10.00				
J-G	0 0	-18.5 -18.5 0.27 (4)	10.00				
G-K	0 0	-18.5 -18.5 0.27 (4)	10.00				
K-L	0 0	-18.5 -18.5 0.27 (4)	10.00				
L-F	0 0	-18.5 -18.5 0.27 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-9-0	-88	-88	---	FRONT	VERT	DEAD	---	C1
C	5-9-0	-82	-82	---	BACK	VERT	TOTAL	---	C1
C	5-9-0	-435	-435	---	FRONT	VERT	SNOW	---	C1
G	5-11-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
I	1-11-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
J	3-11-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
K	7-11-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
L	9-11-4	-17	-17	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
OL = 8.0 PSF
BOT CH. LL = 0.0 PSF
OL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, ORC 2012, ABC 2019
- PART 9 OF ORC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.38")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.38")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CSI: TC=0.65/1.00 (C-D:1), BC=0.27/1.00 (G-H:4),
WB=0.28/1.00 (B-G:1), SSI=0.20/1.00 (C-D:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 518 354 1667 788 1967 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.59 (B) (INPUT = 0.90)
JSI METAL=0.33 (D) (INPUT = 1.00)

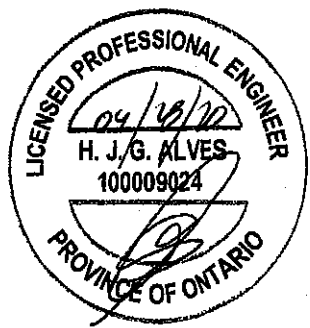


JOB NAME 408268	TRUSS NAME T43	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:54:45 2020 Page 1

ID:DMCubINVR8TsIFoe31v6l_zns1l-kzvgmwtkuOQW6GZpUKkzK7Mp_2AWEKjZg8m?ZxzMEVO

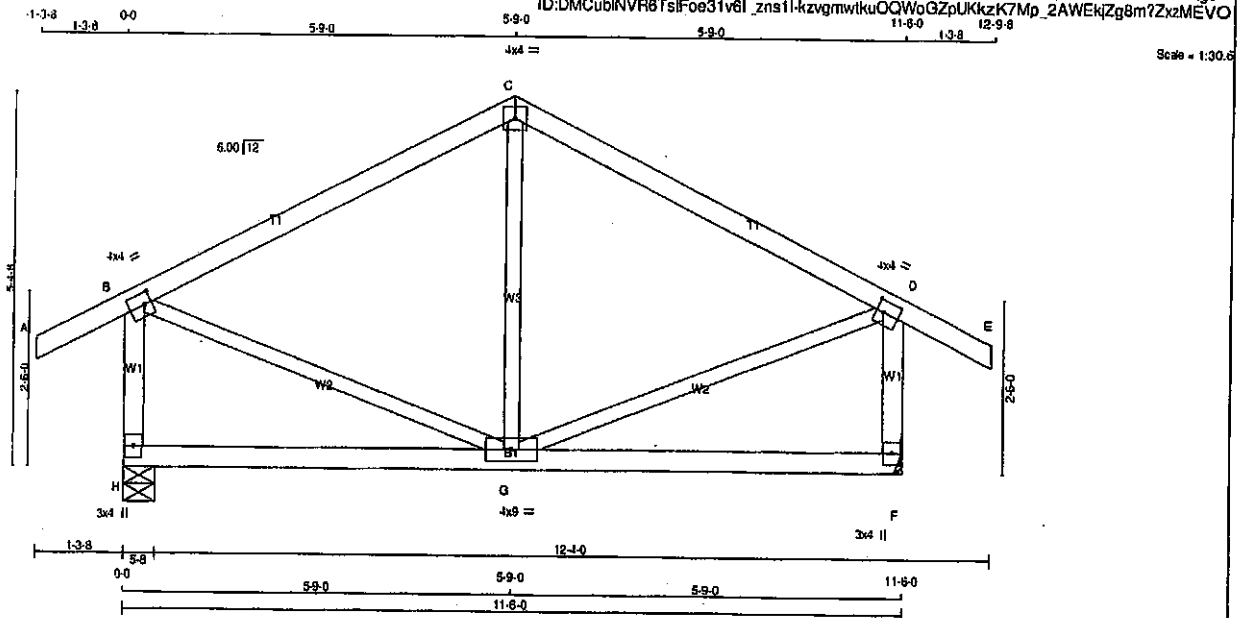

Scale = 1:30.6

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF		
C - E	2x4 DRY	No.2	SPF		
H - B	2x4 DRY	No.2	SPF		
F - D	2x4 DRY	No.2	SPF		
H - F	2x4 DRY	No.2	SPF		
ALL WEBS	2x3 DRY	No.2	SPF		
EXCEPT					

DRY, SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	4.0	2.00 1.25
C	TTW-p	MT20	4.0	4.0	
D	TMVW-1	MT20	4.0	4.0	2.00 1.25
F	BMV1-p	MT20	3.0	4.0	
G	BMWW-1	MT20	4.0	9.0	
H	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
H	758	0	758	0
F	758	0	758	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	534	364.0	0.0	0.0	0.0	0.0	170.0	0.0
F	534	364.0	0.0	0.0	0.0	0.0	170.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1 MAX (PLF)	MEMB.	FORCE (LBS)
FR-TO			FR-TO	
A-B	0 28	-91.8 -91.8 0.12 (1)	G-C	-154 42
B-C	-418 0	-91.8 -91.8 0.39 (1)	B-G	0 400
C-D	-418 0	-91.8 -91.8 0.39 (1)	G-D	0 400
D-E	0 28	-91.8 -91.8 0.12 (1)		
H-B	-718 0	0.0 0.0 0.09 (1)		
F-D	-718 0	0.0 0.0 0.09 (1)		
H-G	0 0	-18.5 -18.5 0.17 (4)		
G-F	0 0	-18.5 -18.5 0.17 (4)		

TOTAL WEIGHT = 2 X 49 = 98 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCG 2010, NBCG 2012, ABC 2019
- PART 9 OF NBCG 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.38")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.38")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSI: TC=0.39/1.00 (B-C:1), BC=0.17/1.00 (G-H:4), WB=0.09/1.00 (D-G:1), SS=0.18/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1856


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.64 (B) (INPUT = 0.90)
JSI METAL = 0.22 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007727

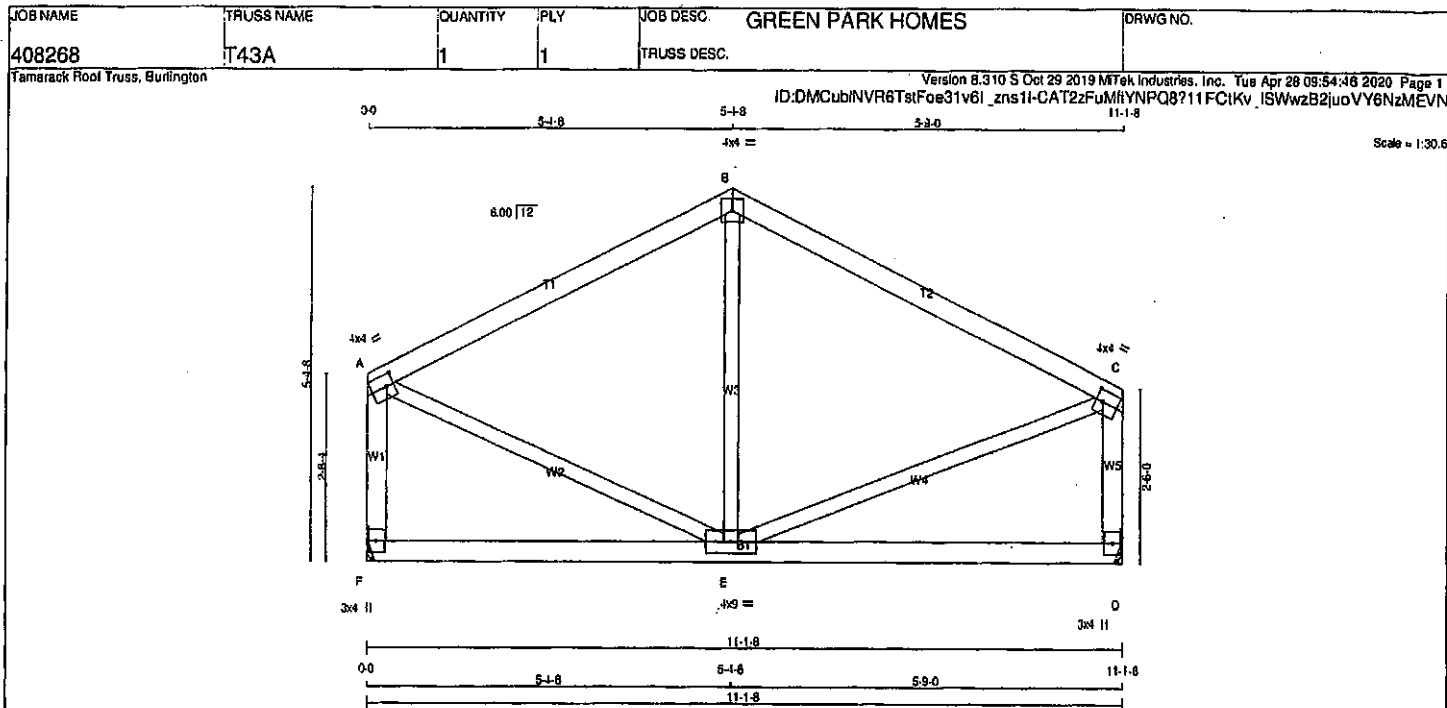

TOTAL WEIGHT = 45 lb (M/F)

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
F - A	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	4.0	4.0	2.00 1.25
B	TTW-p	MT20	4.0	4.0	
C	TMVW-t	MT20	4.0	4.0	2.00 1.25
D	BMV1-p	MT20	3.0	4.0	
E	BMVWW-t	MT20	4.0	9.0	
F	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	DOWN	HORIZ	UPLIFT
IN-SX	IN-SX	MECHANICAL	MECHANICAL
F 613 0	613 0	0	0
D 613 0	613 0	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F, D. MINIMUM BEARING LENGTH AT JOINT F = 1-8, JOINT D = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	MAX. MIN. LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	434	285.0	0.0	0.0	0.0	149.0	0.0
D	434	285.0	0.0	0.0	0.0	149.0	0.0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. UNBRAC. CSl (LC)	MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. UNBRAC. CSl (LC)
FR-TO		FROM	TO	FR-TO			
A-B	-391 0	-91.8	-91.8	0.34 (1)	E-B	-161 36	0.07 (1)
B-C	-391 0	-91.8	-91.8	0.39 (1)	A-E	0 382	0.08 (1)
F-A	-576 0	0.0	0.0	0.08 (1)	E-C	0 -374	0.08 (1)
D-C	-572 0	0.0	0.0	0.07 (1)			
F-E	0 0	-18.5	-18.5	0.18 (4)	10.00		
E-D	0 0	-18.5	-18.5	0.18 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.37")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.37")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSI: TC=0.39/1.00 (B-C:1), BC=0.18/1.00 (E-F:4), WB=0.09/1.00 (A-E:1), SS=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.60 (A) (INPUT = 0.90)
JSI METAL= 0.19 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007728

JOB NAME 408268	TRUSS NAME T44	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 M7ek Industries, Inc. Tue Apr 28 09:54:47 2020 Page 1		ID:DMCubINVR8TsIFoe31v6l_zns11-hM1QBbv_Q7qE1ajCbkmHPYR5asppiXYs7SF6epzMEVM	
		TRUSS DESC.		Scale = 1:10.5	

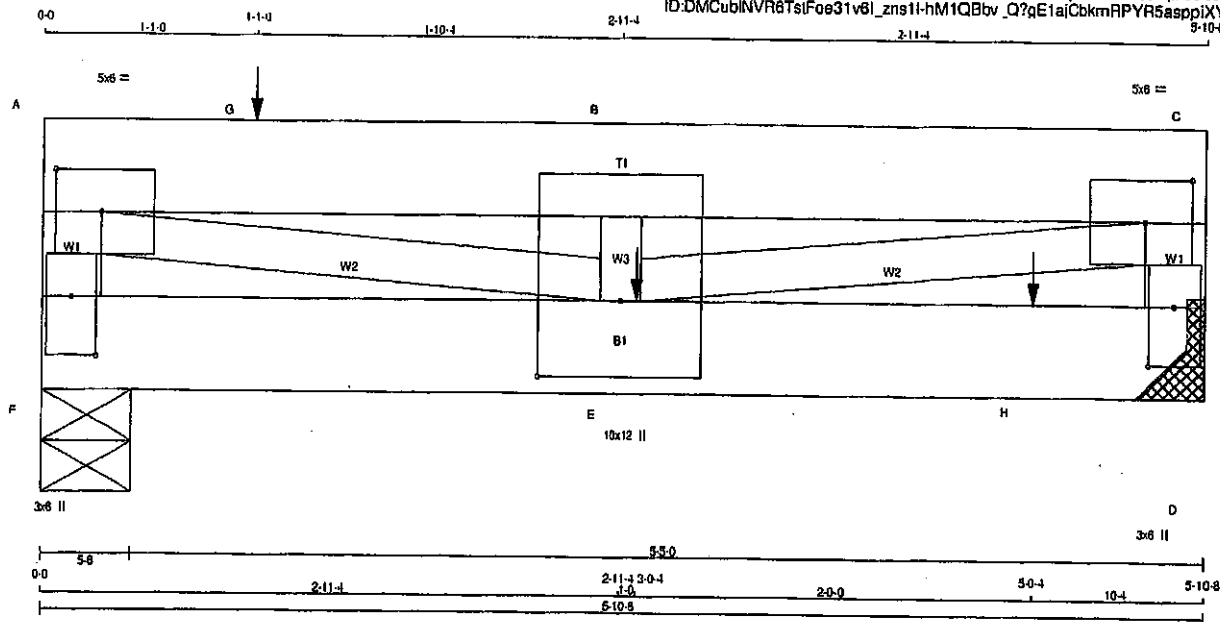

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - A	2x4	DRY	No.2
A - C	2x6	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x6	DRY	No.2
ALL WEBS 2x3 DRY No.2 SPF			
ORY: SEASONED LUMBER.			

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F - A	12	TOP
C - D	12	TOP
A - C	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D	7	SIDE (366.2)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (tablets in inches)					
JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	5.0	6.0	2.50 2.75
B					
C	TMVW-1	MT20	5.0	6.0	2.50 2.75
D	BMV1+P	MT20	3.0	6.0	3.50 1.50
E					
F	TMBMWW-1	MT20	10.0	12.0	4.50 5.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ	UP/LIFT
F	3004	0	3004	0	5-8
D	2819	0	2819	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	2122	1407.0	0.0	0.0	0.0	0.0	715.0	0.0
D	1849	1228.0	0.0	0.0	0.0	0.0	621.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.64 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
F-A	-2785.0	A-E	0.4172
A-G	-3999.0	E-B	-809.0
G-B	-3999.0	B-C	0.4172
B-C	-3999.0	C-D	0.52 (1)
D-C	-1408.0		0.07 (1)
			0.52 (1)
F-E	0.0		
E-H	0.0		
H-D	0.0		

FACTORED CONCENTRATED LOADS (LBS)		LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
JT										
E	3-0-4	-1398	-1398			BACK	VERT	TOTAL		C1
G	1-1-0	-2181	-2181			TOP	VERT	TOTAL		C1
H	5-0-4	-1398	-1398			BACK	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.04")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.07")

CSI: TC=0.84/1.00 (A-B:1), BC=0.38/1.00 (D-E:1), WB=0.52/1.00 (A-E:1), SS=0.53/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.82 (A) (INPUT = 0.90)
JSI METAL = 0.50 (C) (INPUT = 1.00)

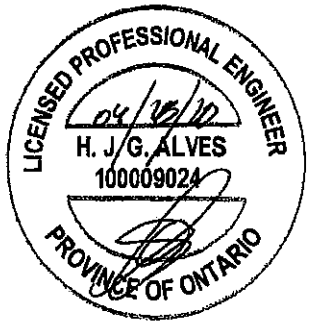

Structural component only
DWG# T-2007729

JOB NAME 408268	TRUSS NAME T44	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:54:47 2020 Page 2
ID:DMCubINVR6TstFos31v6I_zns1I-hM1QBbv_Q7qE1a/CbkmRPYR5asppiXYs7SF6epzMEVM

PLATES (table is in inches)
JT TYPE PLATES W LEN Y X
F BMV1+p MT20 3.0 6.0 3.50 1.50




Structural component only
DWG# T-2007729 2/2

JOB NAME 408222	TRUSS NAME J1	QUANTITY 21	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:00:01 2020 Page 1

ID:DMCubINVR6TsFoe31v6l_zns1l-uBTBW78oHNgUpbVf5dpsEbLZQFMuoV7BWCFEIH2MFH

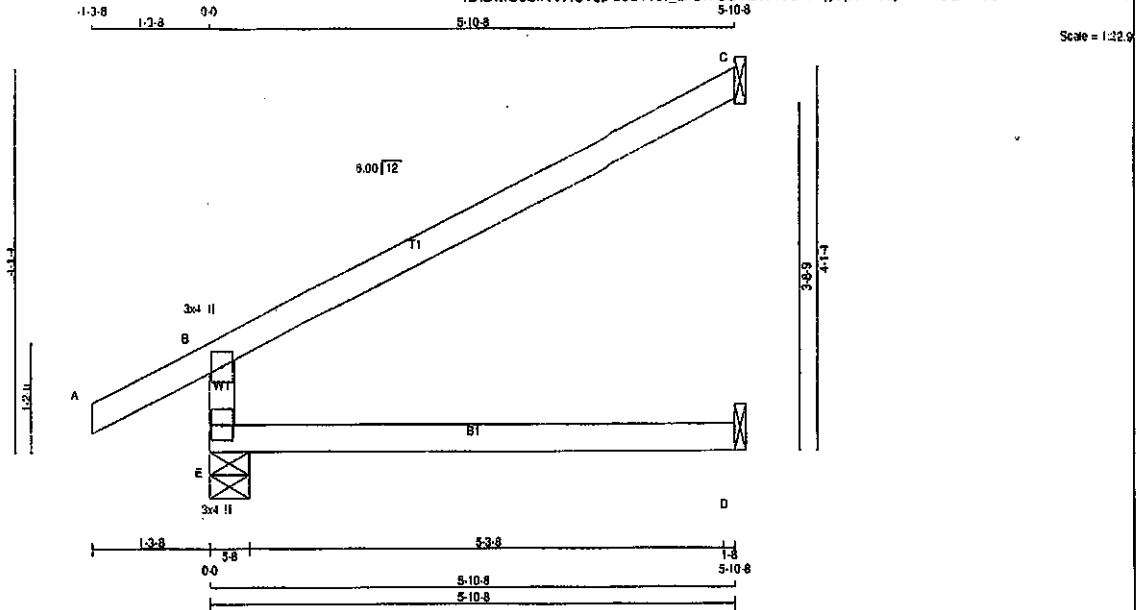

Scale = 1:22.9

TOTAL WEIGHT = 21 X 17 = 353 lb

LUMBER			
N.L.G.A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
E		525	0	525	0	0	5-8	5-8	
C		202	0	202	0	0	1-8	1-8	
D		45	0	50	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B87791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
E	369	257	0	0	0	0	111	0
C	139	113	0	0	0	0	26	0
D	36	0	0	0	0	0	36	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE	VERT. LOAD	LC1 MAX	MEMB.	FORCE	MAX	
	(LBS)	(PLF)	CSI (LC)		(LBS)	CSI (LC)	
FR-TO		FROM	TO	FR-TO			
E-B	-181	0	0.0	0.13 (4)	7.81		
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00	
B-C	-30	0	-91.8	-91.8	0.54 (11)	6.25	
E-D	0	0	-18.5	-18.5	0.13 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")

CALCULATED VERT. DEFL.(LL) = L/999 (0.00")

ALLOWABLE DEFL.(TL) = L/360 (0.20")

CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.54 (1.00 (B-C:1), BC=0.13 (1.00 (D-E:4), WB=0.00 (1.00 (m-a:0), SS=0.24 (1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1667
	788	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.19 (E) INPUT = 0.90

JSI METAL = 0.13 (B) INPUT = 1.00




Structural component only
DWG# T-2007598

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408266	J2S	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310.5 Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:25:54 2020 Page 1

ID:DMCubINVR6TstFos31v6l_zns1l-wypHT1xxYXK7dFk7aHA2g5A4?HQQ9rMndKjvJmzMEwP

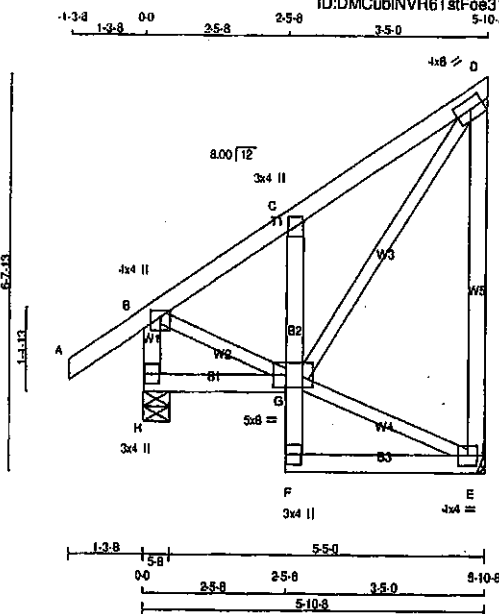

Scale = 1:35.7

LUMBER				DESCR
N. L. G. A. RULES	SIZE	LUMBER		
CHORDS				
H - B	2x4	DRY	No.2	SPF
A - D	2x4	DRY	No.2	SPF
H - G	2x4	DRY	No.2	SPF
F - C	2x4	DRY	No.2	SPF
F - E	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (tablets in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW+p	MT20	4.0	4.0 1.25 2.00
C	TMVW+p	MT20	3.0	4.0
D	TMVW+1	MT20	4.0	6.0 2.00 2.75
E	BMVW+1	MT20	4.0	4.0
F	BMV+p	MT20	3.0	4.0
G	BMVWW+1	MT20	5.0	8.0 2.50 2.50
H	BMV+1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
H	442	0	442	0	0	5-8	5-8
E	316	0	316	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	1ST LOOSE	SNOW	MAX. MIN. COMPONENT REACTIONS	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	310	217.0	0.0	0.0	0.0	0.0	93.0	0.0
E	223	147.0	0.0	0.0	0.0	0.0	77.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO			
H-B	-418.0	0.0	0.0
A-B	0.35	-91.8	-91.8
B-C	-215.0	-91.8	-91.8
C-D	-232.0	-91.8	-91.8
H-G	0.0	-18.5	-18.5
F-G	0.32	0.0	0.0
G-C	-316.0	0.0	0.0
F-E	0.11	-18.5	-18.5

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 089-09, CSA 088-14
- TPC 2011, TPC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = 1/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = 1/999 (0.01")

CSI: TC=0.12/1.00 (A-B:1), BC=0.05/1.00 (E-F:4),
WB=0.14/1.00 (D-E:1), SS=0.11/1.00 (C-D:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 616 354 1067 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.29 (B) (INPUT = 0.90)
JSI METAL = 0.10 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007682

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408266	J3	2	1	GREEN PARK HOMES	
Tamsack Roof Truss, Burlington					

Version 8.310 5 Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:25:55 2020 Page 1
ID:DMCubINVR6TslFoe31v6t_zns11-09NfgNxZlrS_FPIK7_IHDIhBuhkUuKrwS_hTrCzMEwC

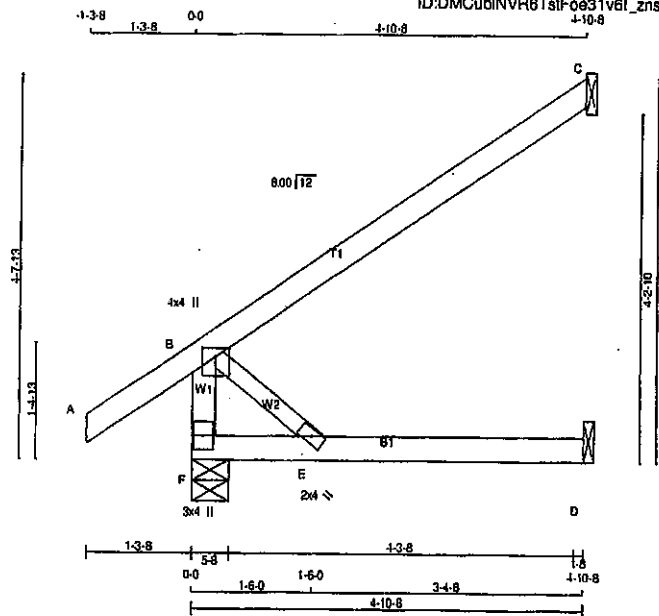

TOTAL WEIGHT = 2 X 17 = 33 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMV+w	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	VERT	HORZ	GROSS REACTION	BRG	BRG
F	395	0	395	0	0
C	224	0	224	0	0
D	45	0	51	0	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	277	195	0	0	0	82	0
C	154	125	0	0	0	29	0
D	38	0	0	0	0	36	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX	MEMB.	FORCE (LBS)	MAX	CS1 (LC1)
FR-TO		FROM TO		FR-TO			
F-B	-350	0	0.0	0.0	0.0	0	0.00 (1)
A-B	0	35	-91.8	-91.8	0.12 (1)	10.00	
B-C	0	0	-91.8	-91.8	0.37 (1)	10.00	
F-E	0	0	-18.5	-18.5	0.11 (4)	10.00	
E-D	0	0	-18.5	-18.5	0.13 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CS1: TC=0.37/1.00 (B-C:1), BC=0.13/1.00 (D-E:4),
WB=0.00/1.00 (B-E:1), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION

JOB NAME 408266	TRUSS NAME J4	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:25:56 2020 Page 1
ID:DMCubINVR6TstF0e31v81_zns1t-sLx1uivC49arsZiWhiDWiWFL243_dn544eR0OezMEwP

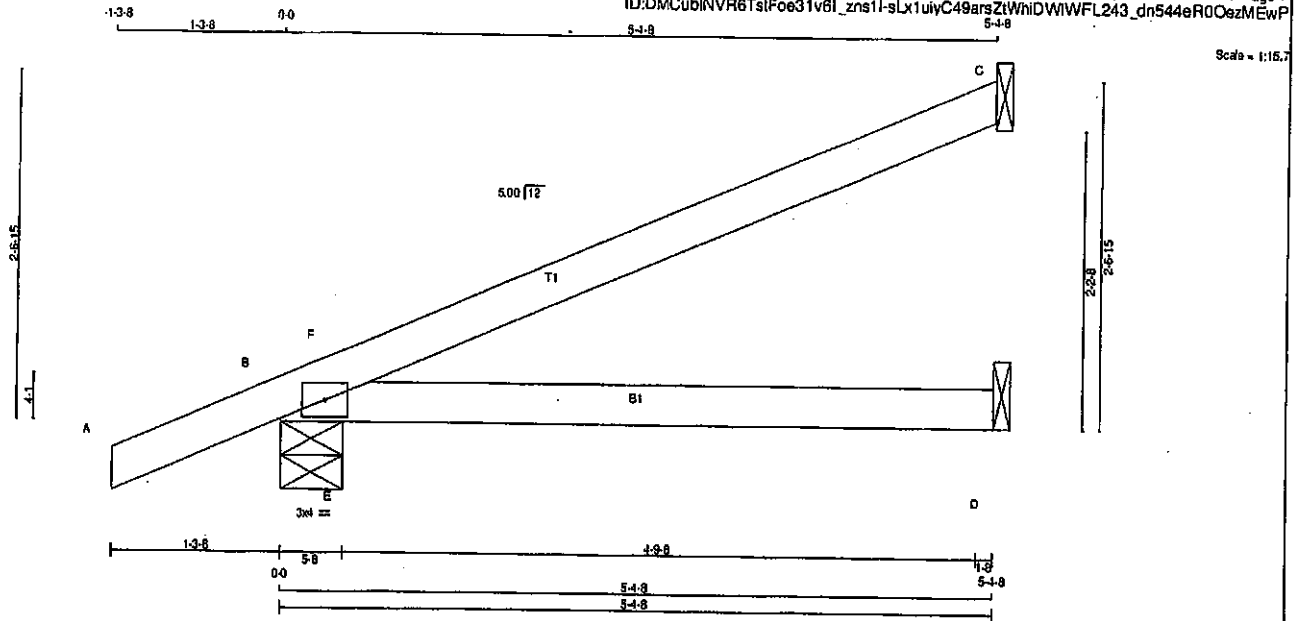

Scale = 1:15.7

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.	SPF
A - C	2x4	DRY	No.2				
B - D	2x4	DRY	No.2				

DRY: SEASONED LUMBER.

PLATES (tablets in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TM81-1	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
C	216	0	216	0	1-8	1-8
B	420	0	420	0	5-8	5-8
D	81	0	81	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	COMBINED	MAX. MIN. COMPONENT REACTIONS		PERM. LIVE	WIND	DEAD	SOIL
		SNOW	LIVE				
C	149	116.0	0.0	0.0	0.0	33.0	0.0
B	295	206.0	0.0	0.0	0.0	88.0	0.0
D	80	21.0	0.0	0.0	0.0	39.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	
A-B	0.23	-91.8	10.00	E-F	-341	11.00	
B-F	-22.38	-91.8	6.25				
F-C	-3.2	-91.8	10.00				
B-E	0.0	-18.5	10.00				
E-D	0.0	-18.5	10.00				

TOTAL WEIGHT = 6 X 15 = 87 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 25.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.18")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.18")
CALCULATED VERT. DEFL.(TL) = L/641 (0.10")

CSK TO=0.34/1.00 (C-F:1), BC=0.24/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SS=0.28/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1887 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.31 (B) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007684

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408267	J20	5	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:31:37 2020 Page 1
ID:DMCubiNVR6TstFoe31v8f_2ns1l-Nx2ySJ45mwYSQzS2ApqU4QldFYTk1?VGVBXYSNzMEr4

Scale = 1:24.0

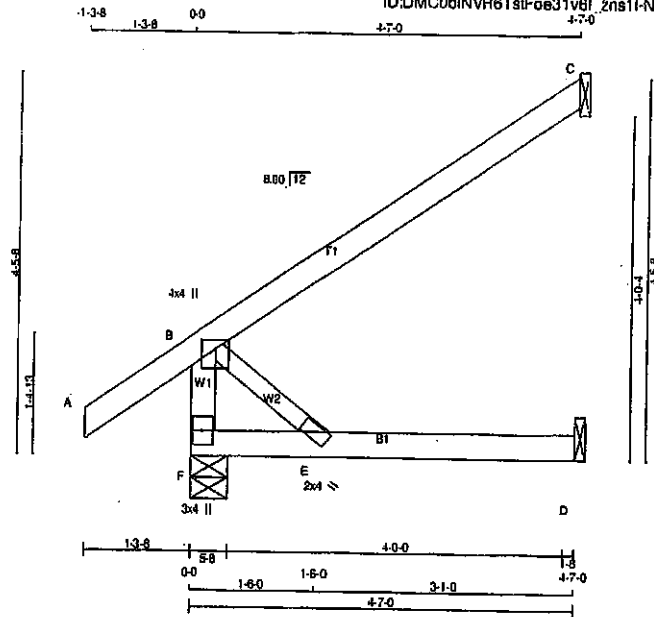

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	No.2
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
F	379	0	379	0	5-8	5-8
C	210	0	210	0	1-8	1-8
D	42	0	42	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOASE	MAX. MIN. COMPONENT REACTIONS				WIND	DEAD	SOIL
		COMBINED	SNOW	LIVE	PERM. LIVE			
F	265	187/0	0/0	0/0	0/0	78/0	0/0	0/0
C	145	117/0	0/0	0/0	0/0	28/0	0/0	0/0
D	34	0/0	0/0	0/0	0/0	34/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED				WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1	MAX	MAX. UNBRAC	MEMB.	FORCE (LBS)	MAX	MAX. UNBRAC
FR-TO		FROM	TO		LENGTH	FR-TO			
F-B	-336/0	0.0	0.0	0.03 (1)	7.81	B-E	0/0	0.00 (1)	
A-B	0/35	-91.8	-91.8	0.12 (1)	10.00				
B-C	0/0	-91.8	-91.8	0.33 (1)	10.00				
F-E	0/0	-18.5	-18.5	0.10 (4)	10.00				
E-D	0/0	-18.5	-18.5	0.11 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 089-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.33/1.00 (B-C:1), BC=0.11/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.14/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PS)	SECTION (PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.29 (B) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)

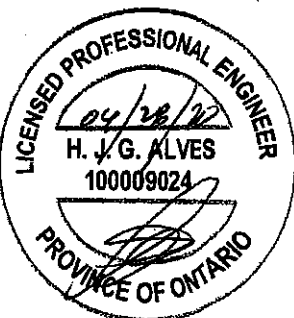


Structural component only
DWG# T-2007698

JOB NAME 408267	TRUSS NAME J21	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:31:38 2020 Page 1
ID:DMCubINVR8TstFoa31v6l, zns1l-r6bKf15jXEGJu61 FjXLjoePr5yq8mSIPrH6OqzMER3
2-8-8

Scale = 1:18.8

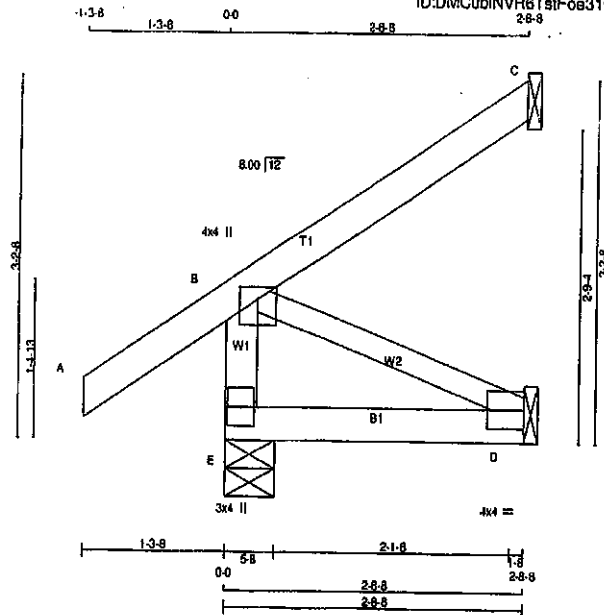

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
D	BMW1-l	MT20	4.0	4.0	2.00 Edge
E	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	HORZ	BRG	IN-SX	BRG	IN-SX
E	274	0	274	0	0	5-8	5-8	5-8	5-8
C	124	0	124	0	0	1-8	1-8	1-8	1-8
D	24	0	27	0	0	1-8	1-8	1-8	1-8

SEE MTEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	DEAD	SOIL	DEAD	SOIL
E	191	140 / 0	0 / 0	0 / 0	0 / 0	52 / 0	0 / 0	16 / 0	0 / 0	19 / 0	0 / 0
C	88	69 / 0	0 / 0	0 / 0	0 / 0	16 / 0	0 / 0	19 / 0	0 / 0	19 / 0	0 / 0
D	19	0 / 0	0 / 0	0 / 0	0 / 0	19 / 0	0 / 0	19 / 0	0 / 0	19 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FORCE (LBS)	MAX. CSI (LC)	MAX. CSI (LC)
FR-TO		FROM TO		FR-TO			
E-B	-250 0	0.0 0.0	0.03 (1)	8-D	0 / 0	0.00 (1)	
A-B	0 35	-91.8 -91.8	0.13 (5)				
B-C	0 0	-91.8 -91.8	0.11 (1)				
E-D	0 0	-18.5 -18.5	0.04 (4)				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 12 = 36 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 8 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.13/1.00 (A-B:5), BC=0.04/1.00 (D-E:4), WB=0.00/1.00 (B-D:1), SSI=0.08/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007699

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408268	J31	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:54:28 2020 Page 1
ID:DMCubINVR6TsIFoe31v6I_zns11-kINEB6g4uAHwFimY_Fw_8Y9ztCPOI3v3I_8bTOzMEV

Scale = 1:20

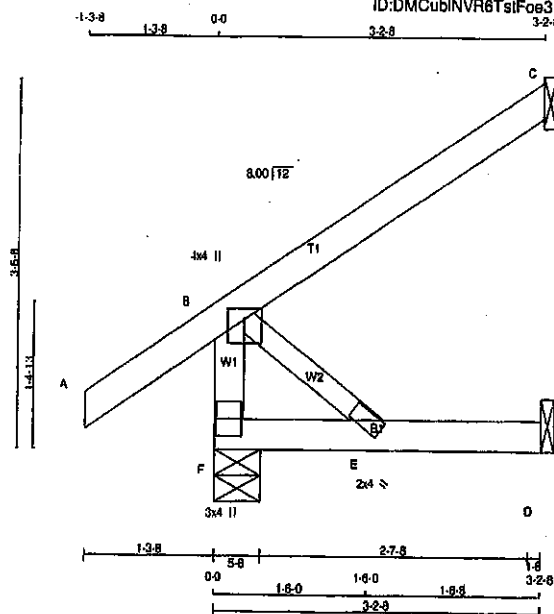

LUMBER				
N.L.G.A. RULES	SIZE	LUMBER	DESCR.	
CHORDS	2x4	No.2	SPF	
F - B	2x4	DRY	SPF	
A - C	2x4	DRY	No.2	
F - D	2x4	DRY	No.2	
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS									
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG					
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
F	303	0	303	0	0	5-8	5-8		
C	147	0	147	0	0	1-8	1-8		
D	30	0	33	0	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B97781H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS									
JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOL		
F	212	152 / 0	0 / 0	0 / 0	0 / 0	59 / 0	0 / 0		
C	101	82 / 0	0 / 0	0 / 0	0 / 0	19 / 0	0 / 0		
D	24	0 / 0	0 / 0	0 / 0	0 / 0	24 / 0	0 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM	TO	FR-TO			
F-B	-273	0.0	0.0	0.03 (1)	7.81	0.0	0.00 (1)
A-B	0	-91.8	-91.8	0.13 (5)	10.00		
B-C	0	-91.8	-91.8	0.16 (1)	10.00		
F-E	0	-18.5	-18.5	0.08 (4)	10.00		
E-D	0	-18.5	-18.5	0.08 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 4 X 12 = 50 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = 1/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = 1/999 (0.00")

CS1: TC=0.18/1.00 (B-C:1), BC=0.06/1.00 (D-E:4), WB=0.04/1.00 (B-E:1), SS=0.10/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.19 (B) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007712

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408266	C1	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Tue Apr 28 09:25:47 2020 Page 1					
ID:DMCubINVR6TstFoe31v6I_zns11-dcud?drYBOS7HAhnfJYPucNrCS7d1jsl0kl2ZgzMEWY					
Scale = 1:22.3					

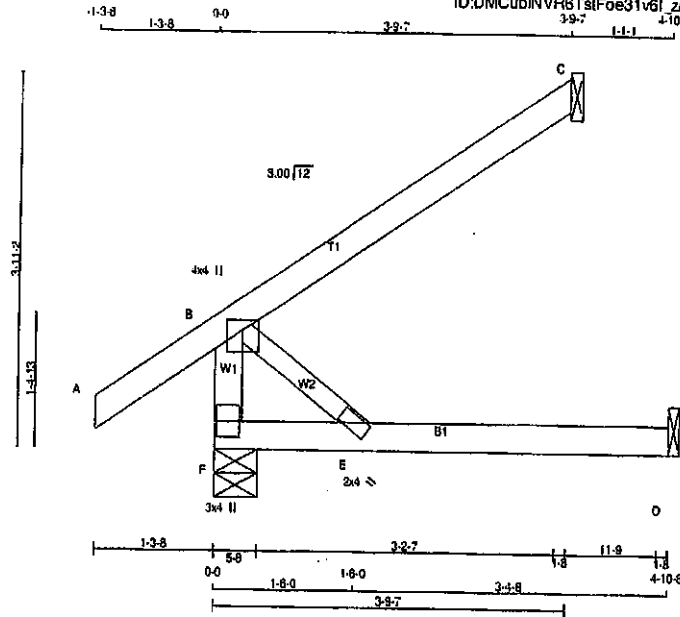

LUMBER				
N. L. G. A. RULES	SIZE	LUMBER	DESCR.	SPF
CHORDS				
F - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMVW+p	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
F	345	0	345	0	5-8
C	174	0	174	0	1-8
D	45	0	51	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED								
F	242	187	0	0	0	0	0	75	0
C	120	97	0	0	0	0	0	23	0
D	36	0	0	0	0	0	0	36	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	WESS	MAX. FACTORED MEMB. FORCE (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)
FR-TO									
F-B	0	0	0	0	0	7.81	B-E	0	0
A-B	0	35	-91.8	-91.8	0.12	10.00			
B-C	0	0	-91.8	-91.8	0.22	10.00			
F-E	0	0	-18.5	-18.5	0.11	14			
E-D	0	0	-18.5	-18.5	0.13	14			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.22/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.21 (B) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007676

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408266	C2	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:25:48 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-5oS0CzsAyzhvKQ_D03eRqW2WslmAGuFOVb66zMewX
Scale = 1:15.8

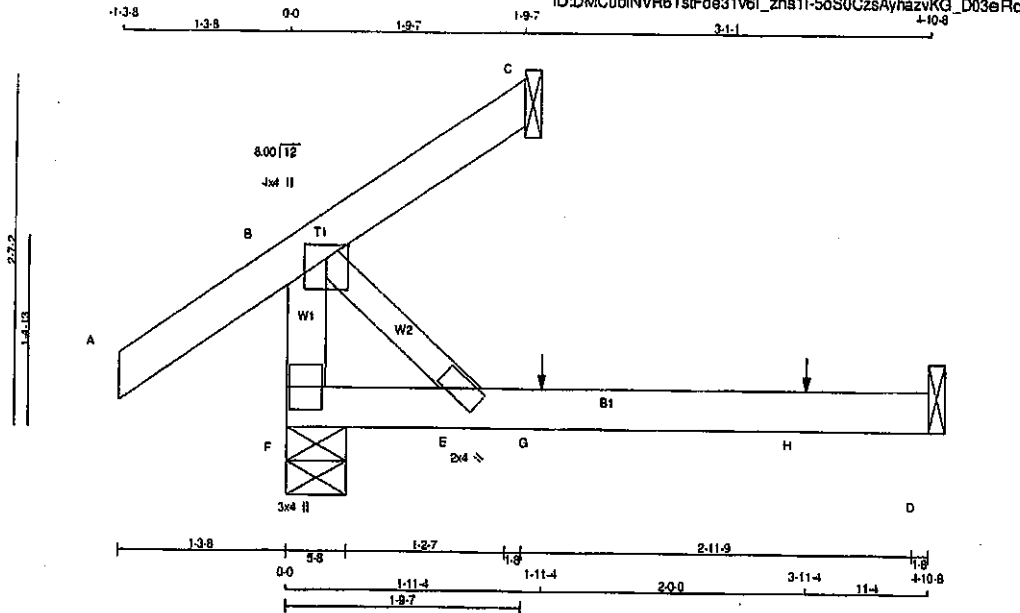

LUMBER
N. L. G. A. RULES
CHORDS SIZE DRY LUMBER
F - B 2x4 DRY No.2
A - C 2x4 DRY No.2
F - D 2x4 DRY No.2
ALL WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

DESCR.
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER
BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
F	301	0	301	0
C	34	0	34	0
D	46	0	51	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	213	143	0	0/0	0/0	70/0	0/0
C	23	19/0	0/0	0/0	0/0	4/0	0/0
D	38	0/0	0/0	0/0	0/0	36/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	FACTORED VERT. LOAD LC1 MAX (LC)	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED GSI (LC)
FR-TO							FR-TO		
F-B	-266	0	0.0	0.0	0.03 (1)	7.81	B-E	0/0	0.00 (1)
A-B	0/35		-91.8	-91.8	0.12 (1)	10.00			
B-C	-27/0		-91.8	-91.8	0.12 (1)	6.25			
F-E	0/0		-18.5	-18.5	0.10 (4)	10.00			
E-G	0/0		-18.5	-18.5	0.13 (4)	10.00			
G-H	0/0		-18.5	-18.5	0.13 (4)	10.00			
H-D	0/0		-18.5	-18.5	0.13 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	1-11-4	1	1	---	BACK	VERT	TOTAL	---	C1
H	3-11-4	1	1	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 12 = 25 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015


THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTER

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408266	C3	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:25:49 2020 Page 1
ID:DMCubINVR6TsiFoa31v6I_zns1I-Z700QJtp?iQWUrAnkbtz1SBiGjqUdM2T2E8eYzMEwWV

Scale = 1:22.5

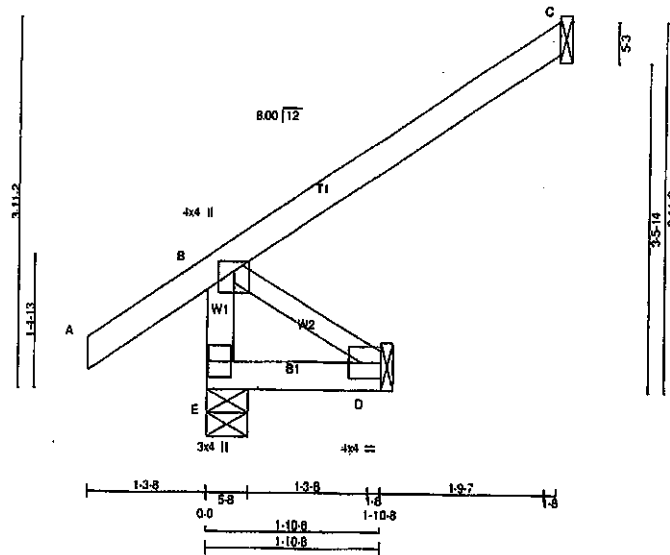

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW+p	MT20	4.0	4.0 1.25 2.00
D	BMV1-i	MT20	4.0	4.0 2.00 Edge
E	BMV1+p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG	IN-SX	IN-SX	
E	316	316	0	5-8	5-8		
C	174	174	0	1-8	1-8		
D	16	16	0	1-8	1-8		

SEE MITEK STANDARD DETAIL R97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
JT	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	219	167.0	0.0	0.0	0.0	52.0	0.0
C	120	97.0	0.0	0.0	0.0	23.0	0.0
D	13	0.0	0.0	0.0	0.0	13.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO		FR-TO			
E-B	-300.0	0.0	0.03 (1)	B-D	0.0	0.00 (1)	
A-B	0.35	-91.8	-91.8 0.13 (5)				
B-C	0.0	-91.8	-91.8 0.22 (1)				
E-D	0.0	-18.5	-18.5 0.02 (4)				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 12 = 36 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/989 (0.00")

CSI: TC=0.22/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (B-D:1), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES				
PLATE	GRIP (DRY)	SHEAR	SECTION	
	(PSI)	(PLI)	(PLI)	
MT20	618	354	1687	788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (B) (INPUT = 0.90)
JSI METAL = 0.08 (B) (INPUT = 1.00)

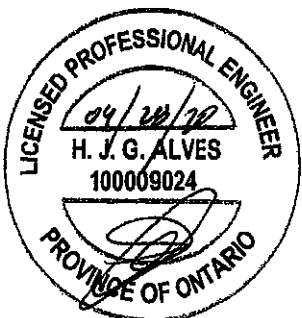


Structural component only
DWG# T-2007678

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408266	C4	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:25:50 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-2BamdfuRUJqh8eQMLR66WF?O0q33D3dBi_lA?zMEwV

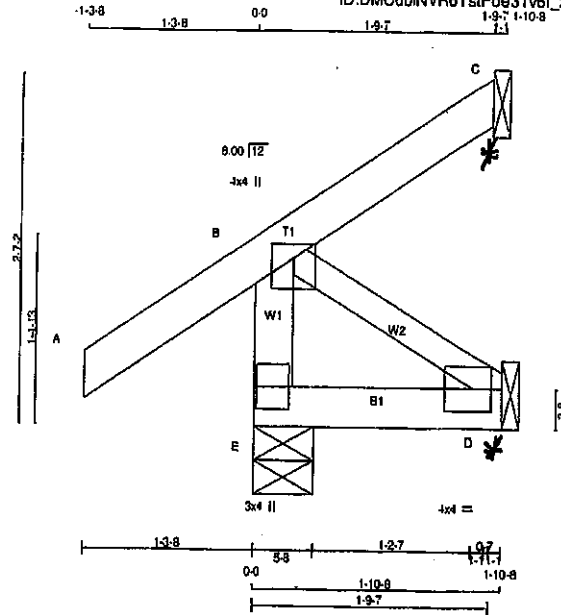

Scale = 1:15.8

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2	
A - C	2x4	DRY	No.2	
E - D	2x4	DRY	No.2	
ALL WEBS	2x3	DRY	No.2	
DRY: SEASONED LUMBER.				

QESCR
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
E	273	0	273	0
C	33	0	33	0
D	18	0	18	0

SEE MTEK STANDARD DETAIL B97791 H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	190	143.0	0.0	0.0	0.0	47.0	0.0
C	23	19.27	0.0	0.0	0.0	4.0	0.0
D	13	0.0	0.0	0.0	0.0	13.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX	MEMB.	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CS1 (LC)	UNBRAC	LENGTH	FR-TO	MEMB.	FORCE (LBS)
FR-TO								
E-B	-256 0	0.0	0.0	0.03 (1)	7.81	B-D	0 0	0.00 (1)
A-B	0 35	-91.8	-91.8	0.12 (1)	10.00			
B-C	-27 0	-91.8	-91.8	0.12 (1)	6.25			
E-D	0 0	-18.5	-18.5	0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 9 = 28 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (TL) = L/360 (0.18")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CS1: TG=0.12/1.00 (A-B:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (B-D:1), SS=0.08/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX	MIN	MAX
618	354	1867
788	788	1987

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.18 (B) (INPUT = 0.90)
JSI METAL = 0.05 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007679

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408266	C5	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 6.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:25:52 2020 Page 1
ID:DMCubINVR6TslFoe31v6L_zns1f-ahW2Lvh0w4POxalSs8abq4wTishz5U90TpFlzMEwT

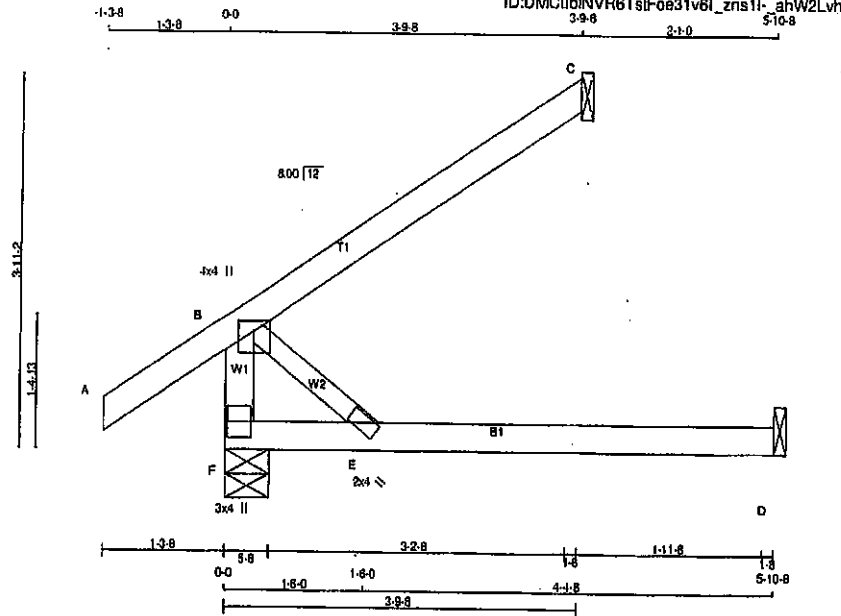

Scale = 1/22.5

TOTAL WEIGHT = 16 lb

LUMBER				DESCR.
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER		
F - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS 2x3 DRY No.2				SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	X
B	TMVW+P	MT20	4.0	4.0	1.25 2.00
E	BMVW+P	MT20	2.0	4.0	
F	BMV1+P	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
		GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
F	354	0	354	0	5-8
C	174	0	174	0	1-8
D	54	0	54	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	250	187.0	0.0	0.0	0.0	83.0	0.0
C	120	97.0	0.0	0.0	0.0	23.0	0.0
D	43	0.0	0.0	0.0	0.0	43.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM	TO	FR-TO			
F-B	-300.0	0.0	0.0	0.03 (1)	7.81	0.0	0.00 (1)
A-B	0.35	-91.8	-91.8	0.12 (1)	10.00		
B-C	0.0	-91.8	-91.8	0.22 (1)	10.00		
F-E	0.0	-18.5	-18.5	0.14 (4)	10.00		
E-D	0.0	-18.5	-18.5	0.19 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
BOT CH. LL = 6.0 PSF
LL = 0.0 PSF
LL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/G

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2015, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSK: TC=0.22/1.00 (B-C:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 518 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (B) (INPUT = 0.80)
JSI METAL = 0.06 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007680

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408266	C6	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 08:25:53 2020 Page 1
ID:DMCubINVR6TstFoe31v6f_zns11-SmFvFhwJnECG759x0afp7tdvD25QQLdOgCMnJzMEwS
5-10-8

Scale = 1:15.8

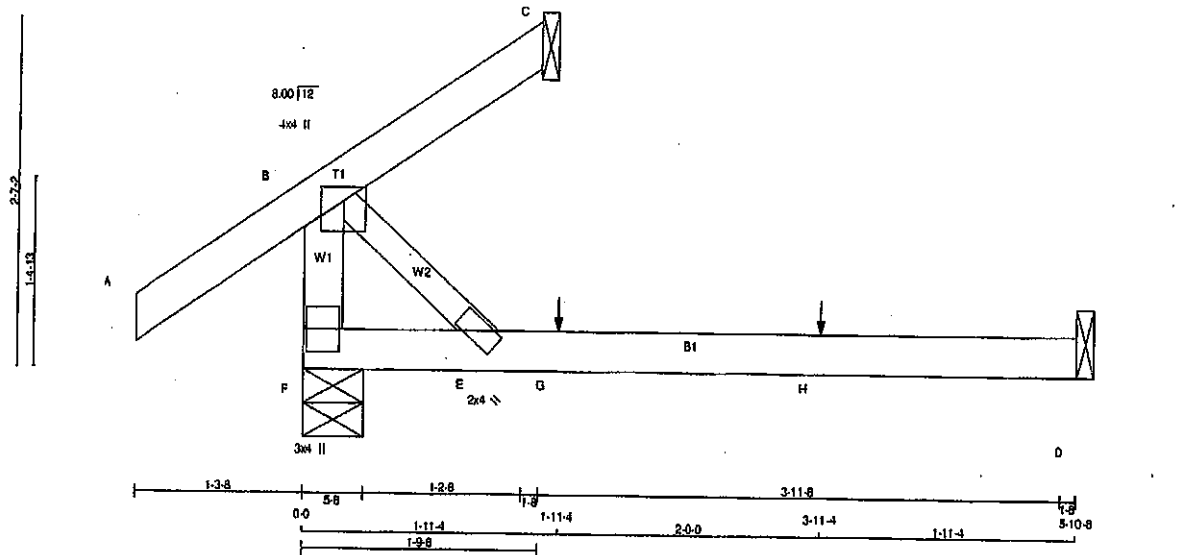

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS	2x4	No.2	SPF
F - B	2x4	DRY	SPF
A - C	2x4	DRY	SPF
F - D	2x4	DRY	SPF
ALL WEBS	2x3	DRY	SPF
DRY: SEASONED LUMBER.			

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW+p	MT20	4.0	4.0 1.25 2.00
E	BMVW+p	MT20	2.0	4.0
F	BMVW+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT RECD BRG
F	311	311	5-8
C	34	34	1-8
D	54	54	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS			
JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	
F	220	143.0	0.0
C	23	19.0	0.0
D	43	0.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED FORCE (LBS)
F-B	-258.0	0.0	0.0
A-B	0.35	-91.8	-91.8
B-C	-27.0	-91.8	-91.8
F-E	0.0	-18.5	-18.5
E-G	0.0	-18.5	-18.5
G-H	0.0	-18.5	-18.5
H-D	0.0	-18.5	-18.5

FACTORED CONCENTRATED LOADS (LBS)			
JT	LOC.	LC1	MAX.
G	1-11.4	1	1
H	3-11.4	1	1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CSI: TC=0.13/1.00 (A-B:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.09/1.00 (B-C:1)

DOL LUMBER=0.98 NAIL=0.98 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1667 768 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.18 (B) (INPUT = 0.90)
JSI METAL = 0.05 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007681

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408268	C30	5	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:54:22 2020 Page 1
 ID:DMCubINVR6TstFoe31v6l_zns1I-vY0zx2cJKWnXkOd_gauHwvAnKpLMQBN3hHFmzMEVl
 3-10-15 5-10-8

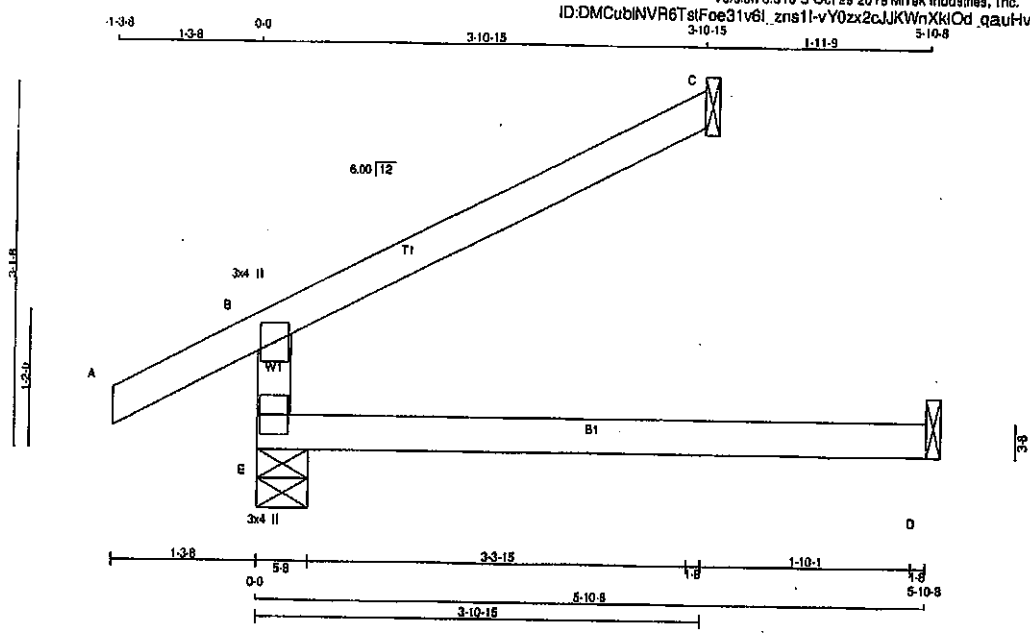

TOTAL WEIGHT = 5 X 14 = 71 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	6MV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	DOWN	IN-SX	IN-SX
E	412	0	5-8	5-8
C	135	0	1-8	1-8
D	45	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
E	291	194 / 0	0 / 0	0 / 0	97	0
C	93	75 / 0	0 / 0	0 / 0	18	0
D	38	0 / 0	0 / 0	0 / 0	38	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

	CHORDS	FACTORED	WEBS	FACTORED
	MEMB.	FORCE (LBS)	MEMB.	FORCE (LBS)
FR-TO				
E-B	-349	0	0.0	0.13 (4)
A-B	0	28	-91.8	-91.8 0.12 (1)
B-C	-20	0	-91.8	-91.8 0.24 (1)
E-D	0	0	-18.5	-18.5 0.13 (4)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.8 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. O.C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF NBC 2018, CBC 2012, ABC 2019
 - PART 9 OF NBC 2012 (2019 AMENDMENT)
 - CSA 088-08, CSA 088-14
 - TPC 2011, TRC 2014

DESIGN ASSUMPTIONS
 - OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
 CALCULATED VERT. DEFL. (LL) = L/998 (0.00")
 ALLOWABLE DEFL. (TL) = L/360 (0.20")
 CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSI: TC=0.24/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (N/A:0), SS=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788	1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.15 (E) (INPUT = 0.90)
 JSI METAL= 0.10 (B) (INPUT = 1.00)

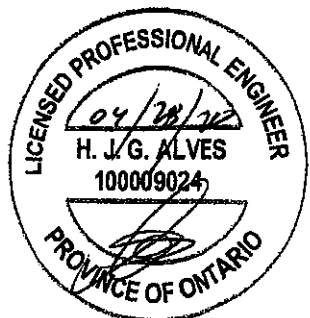


Structural component only
 DWG# T-2007707

JOB NAME 408268	TRUSS NAME C31	QUANTITY 5	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:54:24 2020 Page 1
ID:DMCubiNVR6TstFoe31v6l_zns1l-sx8kMkdZqxnVm2SnIPs2_i_HLb0HpGwTrMAOkeZMEV

Scale = 1:13.4

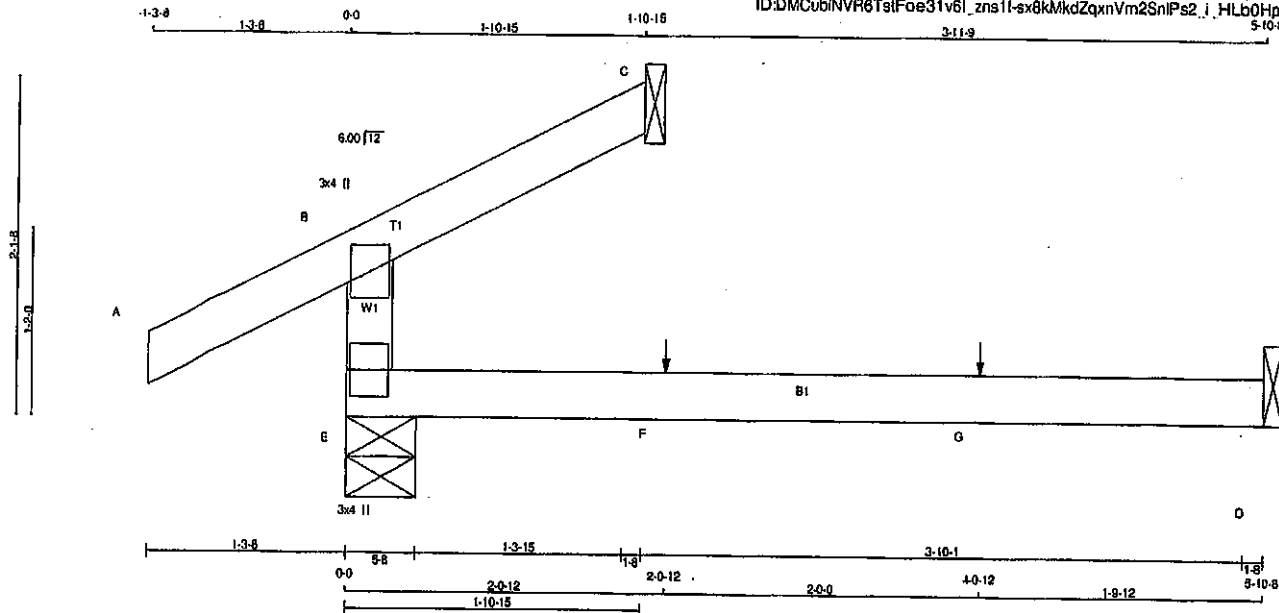

LUMBER	N. L. & A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No. 2	
A - C	2x4	DRY	No. 2	
E - D	2x4	DRY	No. 2	

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	V	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
E	297	0	0	0
C	66	0	0	0
D	45	0	0	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	212	130.0	0.0	0.0	0.0	82.0	0.0
C	46	37.0	0.0	0.0	0.0	9.0	0.0
D	36	0.0	0.0	0.0	0.0	36.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)	MAX. FACTORED VERT. LOAD (LC3)	MAX. FACTORED VERT. LOAD (LC4)	MAX. FACTORED VERT. LOAD (LC5)	MAX. FACTORED VERT. LOAD (LC6)	MAX. FACTORED VERT. LOAD (LC7)	MAX. FACTORED VERT. LOAD (LC8)	MAX. FACTORED VERT. LOAD (LC9)	MAX. FACTORED VERT. LOAD (LC10)
FR-TO													
E-B		-234.0	0.0	0.0	0.13 (4)	7.81							
A-B		0.28	-91.8	-91.8	0.12 (1)	10.00							
B-C		-10.0	-91.8	-91.8	0.08 (1)	10.00							
E-F		0.0	-18.5	-18.5	0.13 (4)	10.00							
F-G		0.0	-18.5	-18.5	0.13 (4)	10.00							
G-D		0.0	-18.5	-18.5	0.13 (4)	10.00							

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	2-0-12	1	1	1	FRONT	VERT	TOTAL	---	C1
G	4-0-12	1	1	1	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 5 X 12 = 59 lb


DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL
---------	----

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408268	C32	5	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:54:25 2020 Page 1
ID:DMCubINVR8TstFoe31v6f_znsf1-K7i6Z4eBbFvMOB1zJ7NHwvXRP7NHVAd30wxs5zMEV

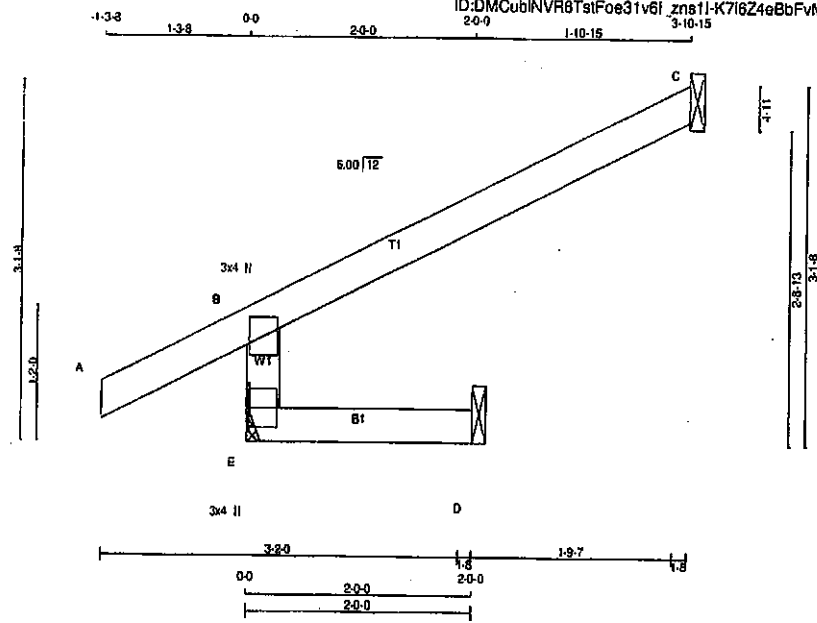

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR
CHORDS	2x4	DRY	SPF
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)			
JT TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0 4.0
E	BMV1+p	MT20	3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
JT	VERT	HORZ	MAXIMUM FACTORED GROSS REACTION
E	389	0	389
C	135	0	135
D	16	0	16

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

SEE MTEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS			
JT	1ST LCASE	MAX MIN. COMPONENT REACTIONS	
E	258	194.0	0.0
C	93	75.0	0.0
D	13	0.0	0.0

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	WEBS MAX. FACTORED FORCE (LBS)
E-B	-349.0	0.0	0.0
A-B	0.28	-91.8	-91.8
B-C	-20.0	-91.8	-91.8
E-D	0.0	-18.5	-18.5

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 5 X 10 = 49 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
OL = 6.0 PSF
BOT CH. LL = 0.0 PSF
OL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIG 2011, TPIG 2014

DESIGN ASSUMPTIONS
OVERHANG NOT TO BE ALTERED OR CUT OFF.

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.24/1.00 (B-C:1), BC=0.02/1.00 (C-E:4), WB=0.00/1.00 (m/a:0), SSI=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLB)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1887 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.15 (E) (INPUT = 0.90)
JSI METAL= 0.10 (B) (INPUT = 1.00)

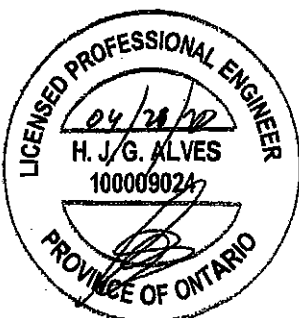


Structural component only
DWG# T-2007709

JOB NAME 408268	TRUSS NAME C33	QUANTITY 5	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:54:26 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns11-oJGUnQpMY1D0Lc9squW374e0QjWH9QmIglVOXzMEVh
1-10-15 2-0-0

Scale = 1:13.4

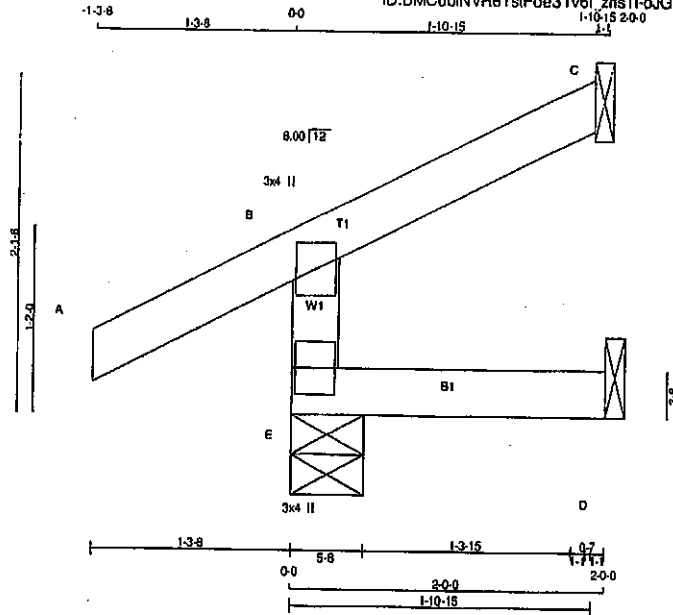

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY, SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT		RECORD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	BRG	BRG
E	254	0	254	0	0	5-8	5-8
C	68	0	68	0	0	1-8	1-8
D	16	0	16	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791 H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	177	130.0	0.0	0.0	0.0	0.0	47.0	0.0
C	46	37.0	0.0	0.0	0.0	0.0	9.0	0.0
D	13	0.0	0.0	0.0	0.0	0.0	13.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS	
MEMB.	FORCE	VERT. LOAD	LC1 MAX	MEMB.	FORCE
	(LBS)	(PLF)	CSI (LC)		(LBS)
FR-TO		FROM	TO	LENGTH	FR-TO
E-B	-234	0	0.0	0.01 (4)	7.81
A-B	0	28	-91.8	-91.8	0.12 (1)
B-C	-10	0	-91.8	-91.8	0.06 (1)
E-D	0	0	-18.5	-18.5	0.02 (4)

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 5 X 7 = 37 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (A-B:0), SS=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	818	354	1687

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.50)
JSI METAL= 0.08 (B) (INPUT = 1.00)

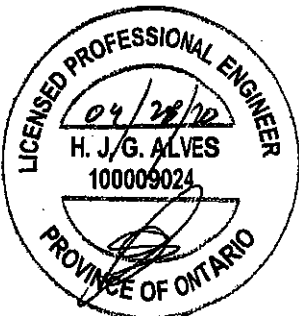

Structural component only
DWG# T-2007710

LUL/LUS/LJS/HUS/HHUS/HGUS

SIMPSON
Strong-Tie

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of a) easier installation, b) higher capacities, c) lower installed cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.


Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on p. 126.

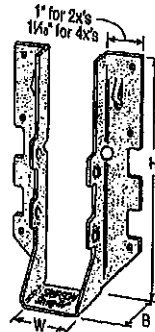


✓ LUS28




LU26L

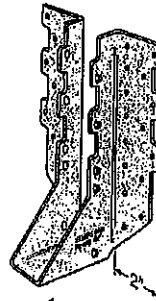

✓ HUS210
(HUS26, HUS28,
and HHUS similar)

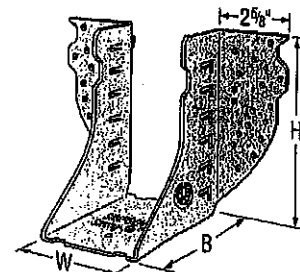

✓ HGUS28-2



✓ HHUS210-2



Double-Shear
Nailing
Top View





Double-Shear
Nailing
Side View;
Do not
bend tab



Dome Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,580

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

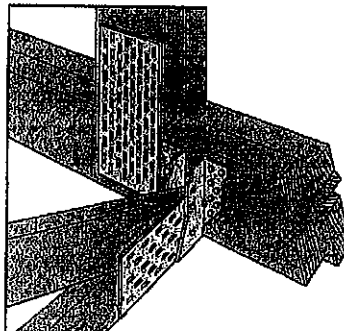

LJS26DS

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options Information on pp. 125–127.


HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
W < 2"	Bevel or square cut	0.62 of table value	0.46 of table value
2" < W < 6"	Bevel cut	0.67 of table value	0.41 of table value
2" < W < 6"	Square cut	0.48 of table value	0.41 of table value
W > 6"	Bevel cut	0.75 of table value	0.41 of table value

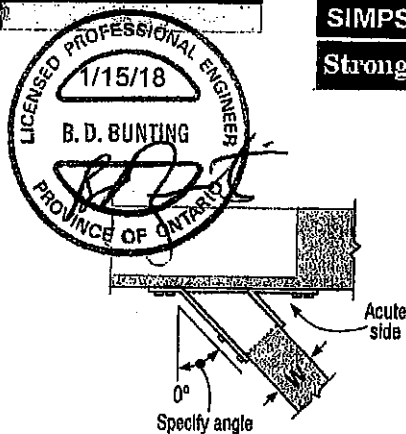

**Top View HHUS Hanger
Skewed Right**
(joist must be bevel cut)
All joist nails installed on the
outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _g ³	Header	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb, kN	(K _D = 1.00) lb, kN	(K _D = 1.15) lb, kN	(K _D = 1.00) lb, kN
Single 2x Sizes											
LUS24	18	1 1/8	3 1/4	1 1/4	2 1/4	(4) 10d	(2) 10d	710 3.18	1625 7.23	845 2.87	1155 5.14
LU24L	22	1 1/8	3	1 1/4	2 1/8	(4) 10d	(2) 10d x 1 1/2"	360 1.60	1020 4.54	320 1.42	725 3.22
LU26L	22	1 1/8	5	1 1/4	4 1/4	(6) 10d	(4) 10d x 1 1/2"	720 3.20	1605 7.14	645 2.87	1140 5.07
LUS26	18	1 1/8	4 1/4	1 1/4	3 1/4	(4) 10d	(4) 10d	1420 6.32	2170 9.65	1290 5.74	1630 7.25
HUS28	16	1 1/8	6 1/4	3	3 3/8	(14) 18d	(8) 18d	2705 11.90	4940 21.97	2065 9.20	3875 17.24
LJS26DS	18	1 1/8	5	3 1/2	4 1/4	(16) 18d	(6) 18d	2055 9.14	4265 18.97	1480 6.49	4115 18.31
HGUS26	12	1 1/8	5 1/4	5	4 1/4	(20) 18d	(8) 18d	2685 11.98	6625 29.51	2685 11.96	5700 25.35
LU28L	20	1 1/8	6 1/4	1 1/4	5 1/4	(8) 10d	(8) 10d x 1 1/2"	1140 5.07	2185 9.72	1020 4.54	1550 6.89
LUS28	18	1 1/8	6 1/4	1 1/4	3 3/4	(8) 10d	(4) 10d	1420 6.32	2520 11.21	1290 5.74	1790 7.96
HUS28	16	1 1/8	7 1/4	3	6 1/8	(22) 18d	(8) 18d	3805 16.04	5365 23.86	2675 11.90	4345 19.33
HGUS28	12	1 1/8	7 1/4	5	6 1/4	(36) 18d	(12) 18d	3310 14.74	7675 34.19	3310 14.74	6900 30.73
LU210L	20	1 1/8	8	1 1/4	7 1/4	(10) 10d	(8) 10d x 1 1/2"	1140 5.07	2495 11.10	1020 4.54	1770 7.87
LUS210	18	1 1/8	7 1/4	1 1/4	3 3/4	(8) 10d	(4) 10d	1420 6.32	2785 12.39	1290 5.74	2210 9.83

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_g is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers


SIMPSON

Strong-Tie

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d ₀ ³	Header	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K ₀ = 1.15)	(K ₀ = 1.00)	(K ₀ = 1.15)	(K ₀ = 1.00)
								lb.	lb.	lb.	lb.
								kN	kN	kN	kN
Double 2x Sizes											
LUS24-2	18	3 1/8	3 1/8	2	1 1/2	(4) 16d	(2) 16d	835	2020	590	1435
SS LUS26-2	18	3 1/8	4 1/8	2	4	(4) 16d	(4) 16d	3.71	8.99	2.62	6.39
SS HHUS26-2	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	1720	2595	1545	1920
SS HGUS26-2	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	7.65	11.54	6.87	8.64
SS LUS28-2	18	3 1/8	7	2	4	(8) 16d	(4) 16d	2850	7335	2065	5205
SS HHUS28-2	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	12.68	32.63	9.20	23.15
SS HGUS28-2	12	3 1/8	7 1/8	4	8 1/8	(36) 16d	(12) 16d	4385	8950	3110	6355
SS LUS210-2	18	3 1/8	9	2	6	(8) 16d	(6) 16d	19.51	39.81	13.83	28.27
SS HHUS210-2	14	3 1/8	9 1/8	3	8	(30) 16d	(10) 16d	1720	3325	1545	2575
SS HGUS210-2	12	3 1/8	9 1/8	4	8 1/8	(48) 16d	(16) 16d	7.65	14.79	6.87	11.45
								3765	8940	2675	6345
								16.75	39.77	11.90	28.22
								6070	12980	4310	9215
								27.00	57.74	19.17	40.99
								2580	4500	2320	3195
								11.48	20.02	10.32	14.21
								4670	9690	4235	7000
								20.77	42.97	18.84	31.14
								6840	14015	4855	10270
								30.43	62.34	21.60	45.69
Triple 2x Sizes											
HGUS26-3	12	4 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
HGUS28-3	12	4 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	19.51	39.81	13.83	28.27
SS HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d	6070	12980	4310	9215
SS HGUS210-3	12	4 1/8	9 1/8	4	8 1/8	(48) 16d	(16) 16d	27.00	57.74	19.17	40.99
								4670	9670	4235	6865
								20.77	43.02	18.84	30.54
								6840	14645	4855	10400
								30.43	65.14	21.60	46.26
Quadruple 2x Sizes											
HGUS26-4	12	6 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
HGUS28-4	12	6 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	19.51	39.81	13.83	28.27
SS HHUS210-4	14	6 1/8	8 1/8	3	7 1/8	(30) 16d	(10) 16d	6070	12980	4310	9215
SS HGUS210-4	12	6 1/8	9 1/8	4	8 1/8	(48) 16d	(16) 16d	27.00	57.74	19.17	40.99
								4670	10155	4235	7210
								20.77	45.17	18.84	32.07
								6840	14645	4855	10400
								30.43	65.14	21.60	48.26
HGUS212-4	12	6 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	7840	14995	5425	10645
HGUS214-4	12	6 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	33.98	66.70	24.13	47.35
								10130	16400	7195	11645
								45.06	72.95	32.00	51.80
4x Sizes											
LUS46	18	3 1/8	4 1/8	2	3 1/8	(4) 16d	(4) 16d	1720	2595	1545	1920
SS HHUS46	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	7.65	11.54	6.87	8.64
SS HGUS46	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	2540	7335	2065	5205
SS LUS48	18	3 1/8	6 1/8	2	3 1/8	(8) 16d	(4) 16d	11.30	32.63	9.20	23.15
SS HHUS48	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	4385	8950	3110	6355
SS HGUS48	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	19.51	39.81	13.83	28.27
SS LUS410	18	3 1/8	8 1/8	2	5 1/8	(8) 16d	(6) 16d	1720	3325	1545	2575
SS HHUS410	14	3 1/8	8 1/8	3	6 1/8	(22) 16d	(8) 16d	7.65	14.79	6.87	11.45
SS HGUS410	12	3 1/8	8 1/8	4	8 1/8	(48) 16d	(16) 16d	3765	8940	2675	6345
SS LUS412	18	3 1/8	10 1/8	2	7 1/8	(12) 16d	(6) 16d	16.75	39.77	11.90	28.22
SS HHUS412	14	3 1/8	10 1/8	3	8 1/8	(30) 16d	(10) 16d	6070	12980	4310	9215
SS HGUS412	12	3 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	27.00	57.74	19.17	40.99
SS LUS414	18	3 1/8	12 1/8	2	9 1/8	(16) 16d	(8) 16d	2580	4500	2320	3195
SS HHUS414	14	3 1/8	12 1/8	3	11 1/8	(48) 16d	(16) 16d	11.48	20.02	10.32	14.21
SS HGUS414	12	3 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	6840	14015	4855	10270
								30.43	62.34	21.60	45.69
								7640	14995	5425	10645
								33.98	66.70	24.13	47.35
								10130	16400	7195	11645
								45.06	72.95	32.00	51.80



Plated Truss Connectors

See footnotes on p. 258.

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1/4". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

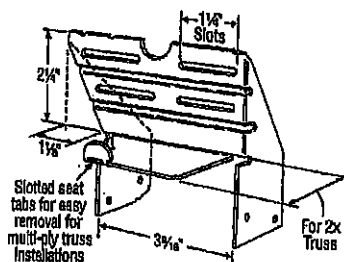


TC24
U.S. Patent 4,932,173

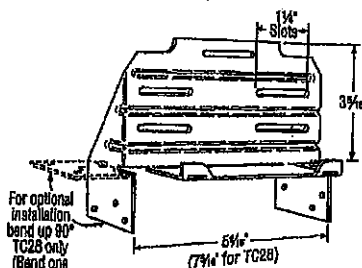


TC26
(TC28 Similar)

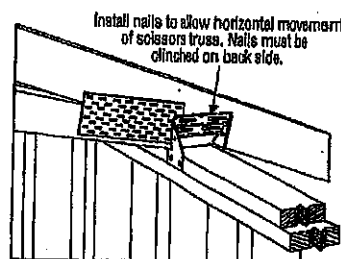

Typical TC24 Installation

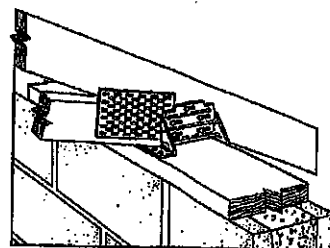

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer
(8", 10", 12" Wall Installation Similar)

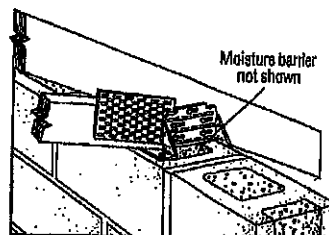

Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift ($K_F=1.15$)	Uplift ($K_F=1.15$)
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(6) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift ($K_F=1.15$)	Uplift ($K_F=1.15$)
TC26	(5) 10d	(6) 10d x 1 1/2"	810	660
	(5) 10d	(6) 10d	930	680

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.
2. Grout strength is 15 MPa minimum.
3. Optional TC26 installation with 10d nails requires minimum 3" top plate thickness.
4. TC26 fastened to grouted concrete block with (6) - 3/8" x 2 1/4" Titen screws has a factored uplift resistance of 276 lb.



(800) 999-5099
strongtie.com

H/TSP

SIMPSON
Strong-Tie

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_D = 1.15$)					
		To Rafters/Truss	To Plates	To Studs	D.Fir-L			S-P-F		
					Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(6) 8d x 1½"	(4) 8d	—	740	685	300	680	485	215
					3.29	3.05	1.33	3.02	2.16	0.96
SS H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
					3.58	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	160	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	265	615	125	190
					3.29	0.80	1.18	2.74	0.56	0.85
H6	16	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	670	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS HB ³	18	(5) 10d x 1½"	(5) 10d x 1½"	—	1120	—	—	1025	—	—
					4.98	—	—	4.58	—	—
SS H10A ⁹	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	565	280
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.64	1.36
H10A-2	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1835	1275	430	1645	880	305
					8.16	5.67	1.91	7.32	3.91	1.36
H10S ^{7,8}	18	(8) 8d x 1½"	(8) 8d x 1½"	(8) 8d	1465	795	315	1040	585	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2½"	(6) 16d x 2½"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	[1] (12) 8d x 1½"	(13) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
		[2] (12) 8d x 1½"	(15) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
TSP	16	(9) 10d x 1½"	(6) 10d x 1½"	—	1295	440	—	920	310	—
					5.76	1.98	—	4.09	1.38	—
		(9) 10d x 1½"	(6) 10d	—	1560	440	—	1105	310	—
					6.94	1.98	—	4.92	1.38	—

- Factored resistances have been increased 15% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 595 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTIECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 6/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1½" nails into the top plates and (3) 8d x 1½" nails into the lowest three flange holes into the truss bottom chord is 495 lb. (2.20 kN).
- Nails: 16d x 2½" = 0.162" dia. x 2½" long, 10d = 0.148" dia. x 3" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long, 8d x 1½" = 0.131" dia. x 1½" long. See pp. 27-28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14; section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

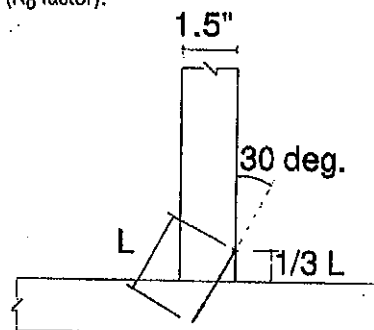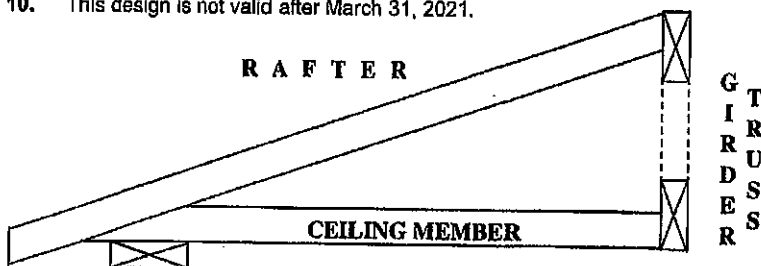


TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek

MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to wind or earthquake load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

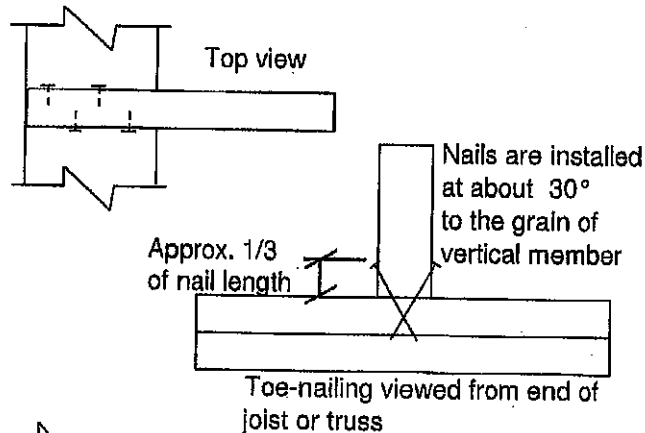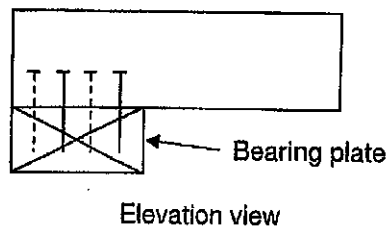

Toe-nailing on 2x4 Bearing Plate

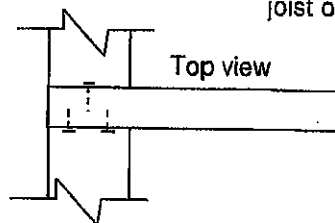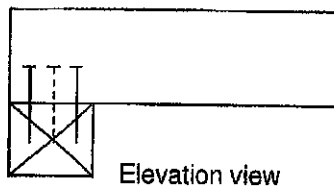

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7


PEO
Certificate No. 10889485




December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint, unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/8" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

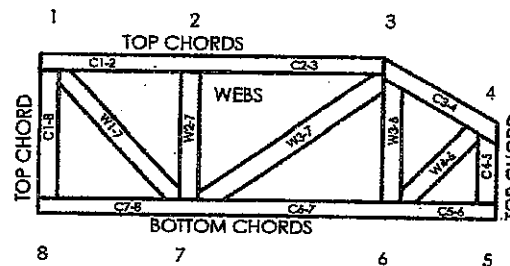

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MII-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See 8CSL.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

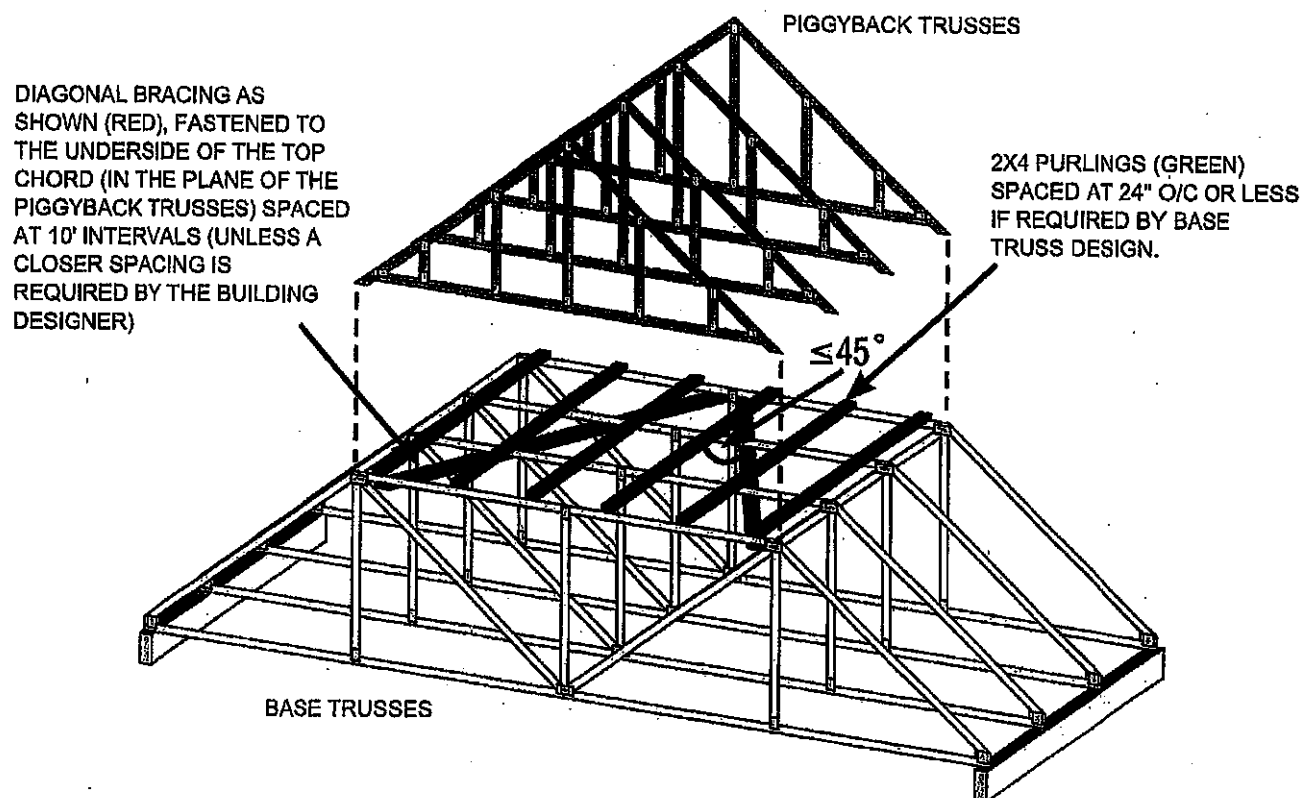

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet M117473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1900219

Feb 09, 2018