


ROOF PITCH 8/12 UNLESS NOTED

32-09-00

44-08-00


1-00-00 6-04-00

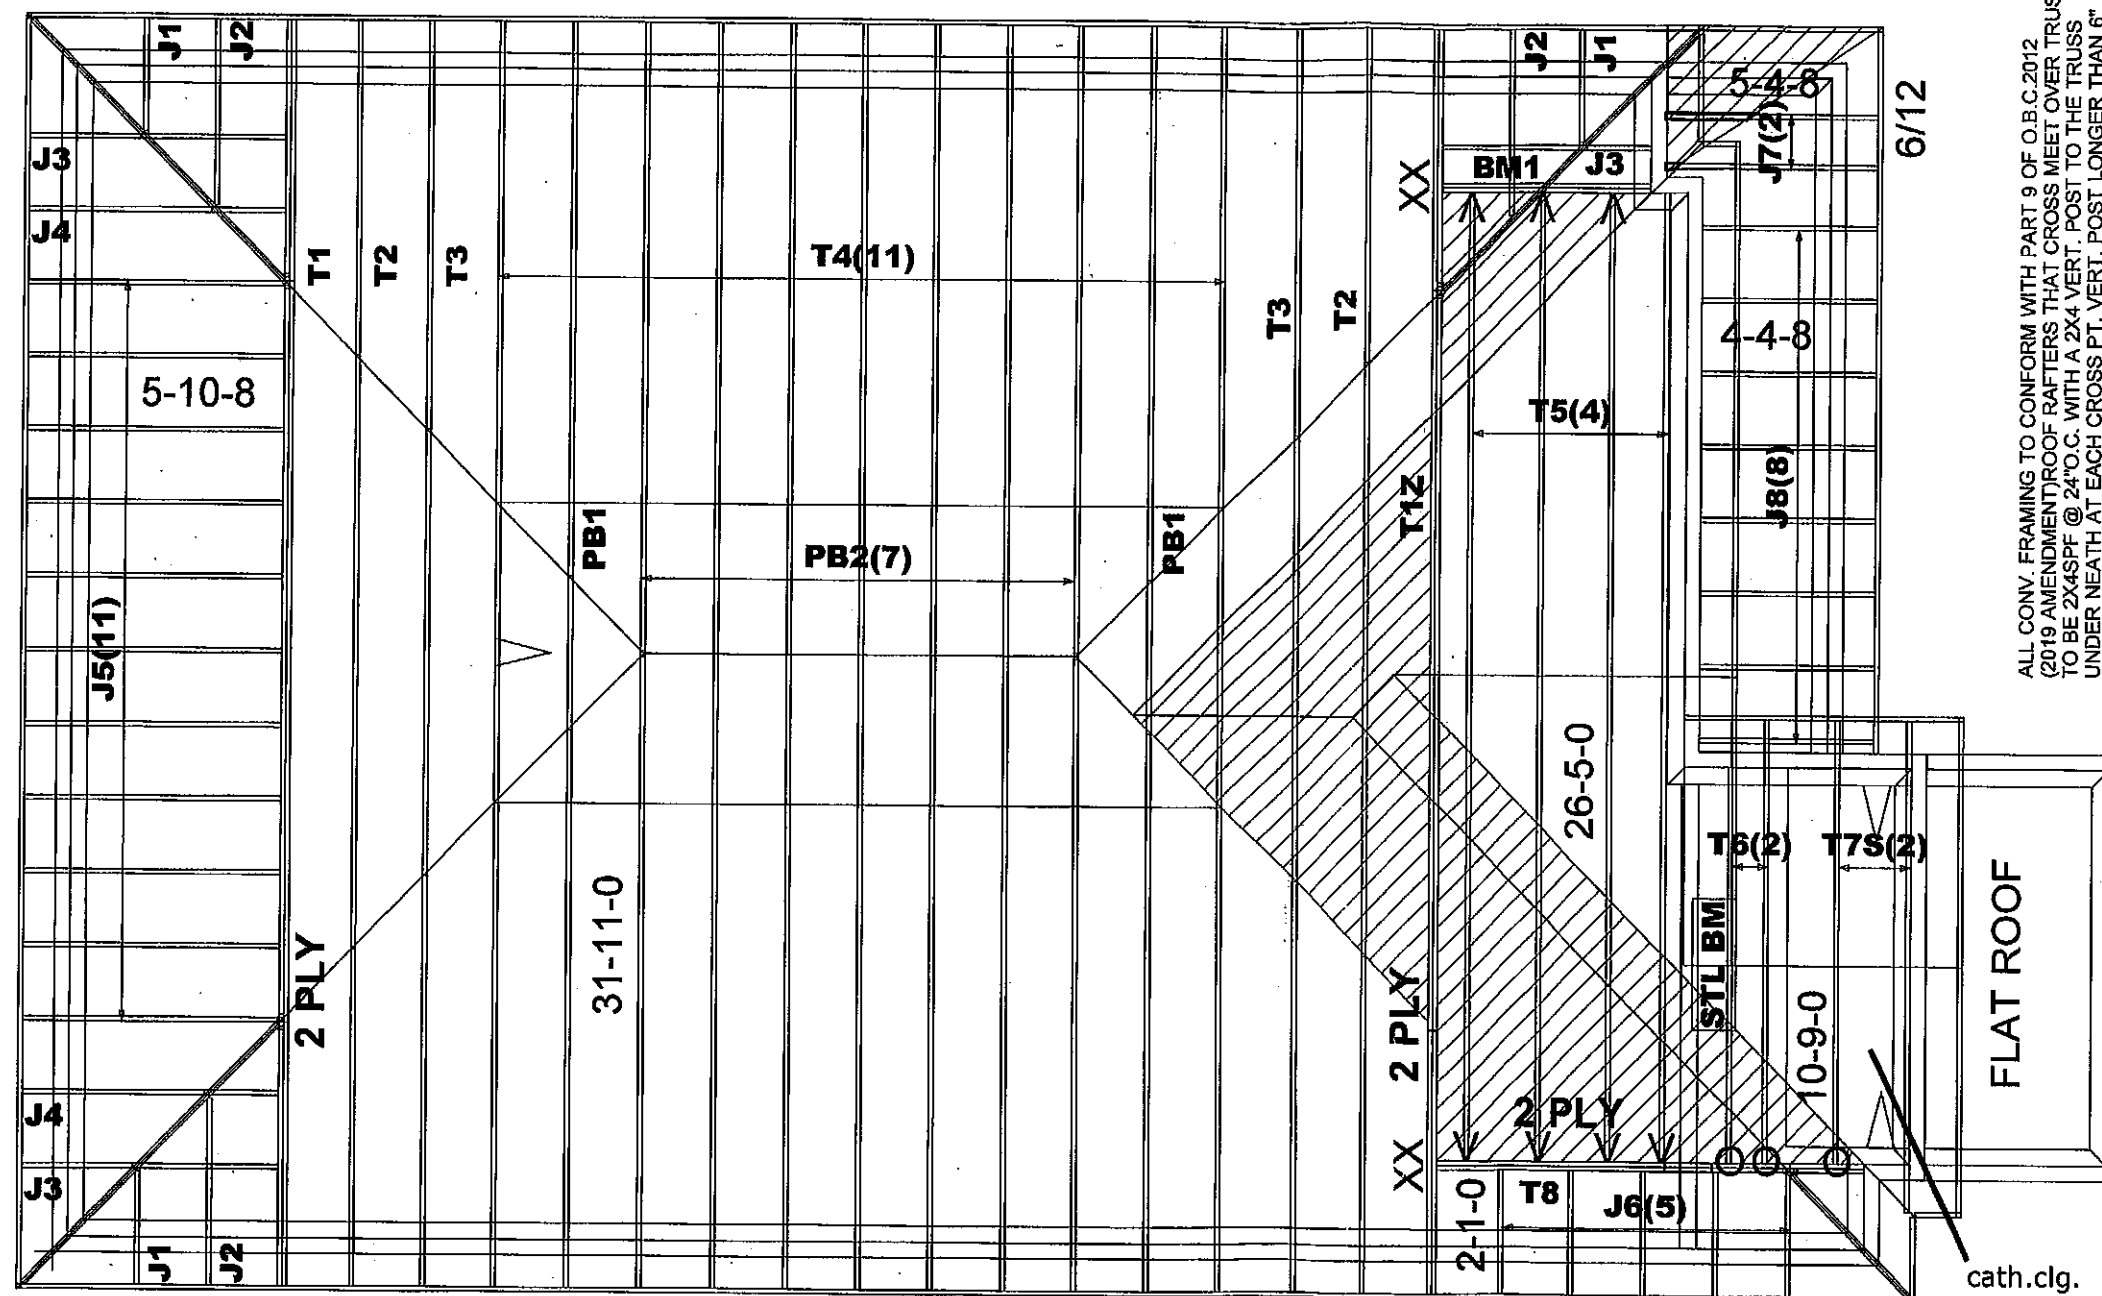

ASPHALT SHINGLES
12"FINISHED OH.
R.T.M.C.
2X6 EXTERIOR WALLS
2X6 FASCIA BOARD


HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)

DENOTES
CONV.
FRAMING



DESIGN CONFORMS
WITH O.B.C.2012 PART 9
(2019 AMENDMENT)
DESIGN LOADS:
SNOW LOAD 25.6 PSF
TC DEAD 6 PSF
BC LIVE 0 PSF
BC DEAD 7.4 PSF

BM1 = 2-2X10

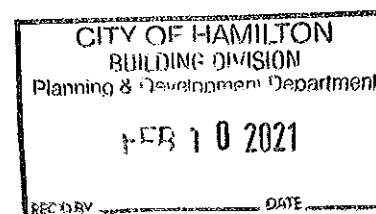

M13110




Job Track: **51225**
Plan Log: **202404**
Layout ID: **408163**

Builder / Location: **GREEN PARK HOMES / WATERDOWN**
Project: **RUSSELL GARDENS PH.3**
Date: 2020-04-15 Sales: **Mario DiCano** Designer: **AC/**

Model / Elevation: **VALLEYCREEK 4/1**

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

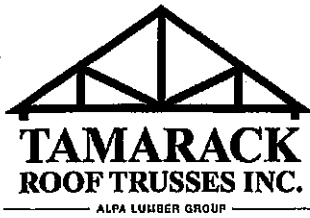

DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Bullder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: VALLEYCREEK 4
 Lot #: 270
 Elevation: 1


Job Track: 51225
 PlanLog: 202404
 Layout ID: 408163
 Ref #
 Page: 1 of 2
 Date: 04-20-2020
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	8 /12	31-11-00	5-03-13	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	325.05 201.00		
	1 2-ply	T1Z Hip Girder	8 /12	31-11-00	5-03-13	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	325.05 201.00		
	2	T2 Hip	8 /12	31-11-00	6-07-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	283.27 180.00		
	2	T3 Hip	8 /12	31-11-00	7-11-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	283.41 178.00		
	11	T4 Hip	8 /12	31-11-00	9-03-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	1657.97 1032.17		
	4	T5 Common	8 /12	26-05-00	10-02-08	2 x 4		1-04-13 1-04-13	483.61 304.00		
	2	T6 Common	8 /12	10-09-00	4-11-13	2 x 4		1-04-13 1-04-13	82.8 53.00		
	2	T7S Scissor	8 /12 5 /12	10-09-00	4-11-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	89.85 60.33		
	1 2-ply	T8 Half Hip Girder	8 /12	11-11-08	2-09-08	2 x 4 2 x 6		1-04-13 2-09-08	124.58 84.33		
	2	PB1 Piggyback	8 /12	8-02-00	1-04-00	2 x 4			43.92 30.00		
	7	PB2 Piggyback	8 /12	8-02-00	2-08-11	2 x 4			142.79 86.33		
	3	J1 Jack-Open	8 /12	1-09-07	2-07-02	2 x 4	1-03-08 1-01	1-04-13 2-07-02	26.71 17.00		
	3	J2 Jack-Open	8 /12	1-10-08	3-11-02	2 x 4	1-03-08 1-10-15	1-04-13 2-07-13	35.12 23.00		
	3	J3 Jack-Open	8 /12	1-09-07	2-07-02	2 x 4	1-03-08 4-01-01	1-04-13 2-07-02	40.4 25.00		

 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: VALLEYCREEK 4 Lot #: 270 Elevation: 1	Job Track: 51225 PlanLog: 202404 Layout ID: 408163 Ref # Page: 2 of 2 Date: 04-20-2020 Designer: Andrew Conway Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	J4 Jack-Open	8 /12	3-09-07	3-11-02	2 x 4	1-03-08 2-01-01	1-04-13 3-11-02	32.8 20.67		
	11	J5 Jack-Open	8 /12	5-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	216.33 133.83		
	5	J6 Jack-Open	8 /12	2-01-00	2-09-08	2 x 4	1-03-08	1-04-13 2-09-08	48.82 35.00		
	2	J7 Jack-Open	6 /12	5-04-08	3-07-15	2 x 4	1-03-08	4-03 2-07-11	30.92 20.00		
	8	J8 Jack-Open	6 /12	4-04-08	3-01-15	2 x 4	1-03-08	4-03 2-01-11	99.04 64.00		

TOTAL # TRUSS= 75 TOTAL BFT OF ALL TRUSSES= 2748.66 BFT. TOTAL WEIGHT OF ALL TRSSES 4371.22 LBS


HARDWARE

QTY	TYPE	MODEL	LENGTH
7	Hardware	LJS26DS	
3	Hardware	LUS24	
2	Hardware	HGUS26-2	


TOTAL NUMBER OF
ITEMS= 12

JOB NAME 408163	TRUSS NAME T1	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:46:35 2020 Page 1
ID:KIHNL7KlAuBVUgBrpQW7E8zls6y-tmv3EgegdKXgcUTINYXUUGDwL2jdjw_1K2addzPlX
31-11-0 31-2-8
Scale = 1:52.8

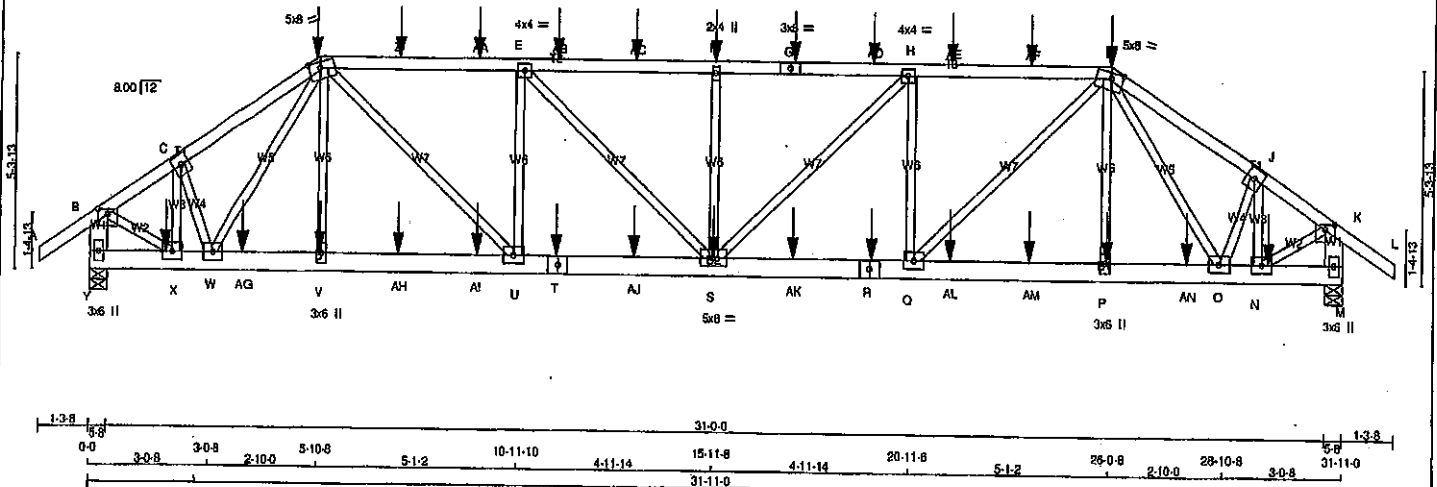

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. A - D 2x4 DRY No.2 SPF D - G 2x4 DRY No.2 SPF G - I 2x4 DRY No.2 SPF I - L 2x4 DRY No.2 SPF Y - B 2x6 DRY No.2 SPF M - K 2x6 DRY No.2 SPF Y - T 2x6 DRY No.2 SPF T - R 2x6 DRY No.2 SPF R - M 2x6 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT DRY: SEASONED LUMBER. DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS: CHORDS #ROWS SURFACE SPACING (IN) LOAD (PLF) TOP CHORDS : (0.122"x3") SPIRAL NAILS A-D 1 12 SIDE(61.0) D-G 1 12 SIDE(61.0) G-I 1 12 SIDE(61.0) I-L 1 12 SIDE(61.0) Y-B 2 12 TOP M-K 2 12 TOP BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS Y-T 2 12 SIDE(183.1) T-R 2 12 SIDE(183.1) R-M 2 12 SIDE(183.1) WEBS : (0.122"x3") SPIRAL NAILS V-D 1 6 SIDE(30.3) P-I 1 6 SIDE(30.3) 2x3 1 6 NAILS TO BE DRIVEN FROM ONE SIDE ONLY. GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS. TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY. SIDE - PLF SHOWN IS THE EQUIVALENT UCL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP. PLATES (table in inches) JT TYPE PLATES W LEN Y X B TMVW-p MT20 5.0 6.0 1.50 3.00 C TMVW-h MT20 5.0 6.0 D TTVWW-m MT20 5.0 6.0 1.75 3.50 E TMVW-i MT20 4.0 4.0 F TMVW-w MT20 2.0 4.0 G TS-i MT20 3.0 6.0 H TMVW-i MT20 4.0 4.0 I TTVWW-m MT20 5.0 6.0 1.75 3.50 J TMVW-h MT20 5.0 6.0 K TMVW-p MT20 5.0 6.0 1.50 3.00 M BMV1-p MT20 3.0 6.0 N, O, Q, U, W, X N BMVW-i MT20 5.0 6.0 P BMVW-w MT20 3.0 6.0 H BS-i MT20 5.0 6.0 S BMVWW-i MT20 5.0 6.0 T BS-i MT20 5.0 6.0				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED MAXIMUM FACTORED INPUT REORD GROSS REACTION GROSS REACTION BRG BRG DOWN HORZ UPLIFT IN-SX IN-SX JT 3538 0 3538 0 0 5-8 5-8 Y 3537 0 3537 0 0 5-8 5-8 M UNFACTORED REACTIONS 1ST LCASE MAX/MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL Y 2500 1855 / 0 0 / 0 0 / 0 845 / 0 0 / 0 M 2499 1854 / 0 0 / 0 0 / 0 845 / 0 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Y, M BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS FACTORED FACTORED WEBS MEMB. FORCE VERT. LOAD LC1 MAX UNBRAC LENGTH FR-TO MEMB. MAX. FORCE MAX (LBS) (PLF) CSI (LC) (LBS) CSI (LC) FR-TO FROM TO A-B 0 / 35 -91.8 -91.8 0.07 (1) 10.00 X-C -1140 / 0 0.10 (1) B-C -3538 / 0 -91.8 -91.8 0.10 (1) 4.91 V-D 0 / 265 0.04 (4) C-D -3862 / 0 -91.8 -91.8 0.15 (1) 4.70 D-U 0 / 2416 0.30 (1) D-Z -5401 / 0 -91.8 -91.8 0.54 (1) 3.65 U-E -1507 / 0 0.31 (1) Z-AA -5401 / 0 -91.8 -91.8 0.54 (1) 3.65 E-S 0 / 703 0.09 (1) AA-E -5401 / 0 -91.8 -91.8 0.54 (1) 3.65 S-F -838 / 0 0.17 (1) E-AB -5901 / 0 -91.8 -91.8 0.57 (1) 3.47 Q-I 0 / 708 0.09 (1) AB-AC -5901 / 0 -91.8 -91.8 0.57 (1) 3.47 Q-H -1505 / 0 0.31 (1) AC-F -5901 / 0 -91.8 -91.8 0.57 (1) 3.48 Q-I 0 / 2413 0.30 (1) F-G -5901 / 0 -91.8 -91.8 0.57 (1) 3.48 P-I 0 / 285 0.04 (4) G-AD -5901 / 0 -91.8 -91.8 0.57 (1) 3.48 N-J -1139 / 0 0.10 (1) AD-H -5901 / 0 -91.8 -91.8 0.57 (1) 3.48 B-X 0 / 3248 0.40 (1) H-AE -5387 / 0 -91.8 -91.8 0.54 (1) 3.65 N-K 0 / 3247 0.40 (1) AE-AF -5387 / 0 -91.8 -91.8 0.54 (1) 3.65 C-W 0 / 681 0.08 (1) AF-I -5387 / 0 -91.8 -91.8 0.54 (1) 3.65 W-D -948 / 0 0.28 (1) I-J -3860 / 0 -91.8 -91.8 0.15 (1) 4.70 O-J 0 / 681 0.08 (1) J-K -3538 / 0 -91.8 -91.8 0.10 (1) 4.91 I-O -947 / 0 0.28 (1) K-L 0 / 35 -91.8 -91.8 0.07 (1) 10.00 Y-B -3500 / 0 0.0 0.0 0.13 (1) 7.48 M-K -3498 / 0 0.0 0.0 0.13 (1) 7.48 Y-X 0 / 0 -18.5 -18.5 0.02 (1) 10.00 X-W 0 / 2981 -18.5 -18.5 0.26 (1) 10.00 W-AG 0 / 3569 -18.5 -18.5 0.30 (1) 10.00 AG-V 0 / 3859 -18.5 -18.5 0.30 (1) 10.00 V-AH 0 / 3865 -18.5 -18.5 0.28 (1) 10.00 AH-AI 0 / 3865 -18.5 -18.5 0.28 (1) 10.00 AI-U 0 / 3865 -18.5 -18.5 0.28 (1) 10.00 U-T 0 / 5401 -18.5 -18.5 0.40 (1) 10.00 T-AJ 0 / 5401 -18.5 -18.5 0.40 (1) 10.00 AJ-S 0 / 5401 -18.5 -18.5 0.40 (1) 10.00 S-AK 0 / 5398 -18.5 -18.5 0.40 (1) 10.00 AK-R 0 / 5398 -18.5 -18.5 0.40 (1) 10.00 R-Q 0 / 5398 -18.5 -18.5 0.40 (1) 10.00 Q-AL 0 / 5363 -18.5 -18.5 0.28 (1) 10.00 AL-AM 0 / 5363 -18.5 -18.5 0.28 (1) 10.00 AM-P 0 / 3859 -18.5 -18.5 0.30 (1) 10.00 P-AN 0 / 3859 -18.5 -18.5 0.30 (1) 10.00 AN-O 0 / 3859 -18.5 -18.5 0.30 (1) 10.00 O-N 0 / 2980 -18.5 -18.5 0.26 (1) 10.00 N-M 0 / 0 -18.5 -18.5 0.02 (1) 10.00				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 25.6 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF CBC 2018, CBC 2012, ABC 2019 - PART 9 OF CBC 2012 (2019 AMENDMENT) - CSA 086-09, CSA 086-14 - TPIC 2011, TPIC 2014 (55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL) = L/360 (1.08") CALCULATED VERT. DEFL.(LL) = L/999 (0.12") ALLOWABLE DEFL.(TL) = L/360 (1.08") CALCULATED VERT. DEFL.(TL) = L/999 (0.23") CSI: TC=0.57/1.00 (E-F:1), BC=0.40/1.00 (S-U:1), WB=0.40/1.00 (B-X:1), SSI=0.23/1.00 (D-E:1) DOL LUMBER-1.00 NAIL=1.00 LBS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00 COMPANION LIVE LOAD FACTOR = 1.00 AUTOSOLVE KEELS OFF TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 788 1987 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. CSI GRIP = 0.85 (I) (INPUT = 0.90) CSI METAL = 0.50 (R) (INPUT = 1.00)			
---	--	--	--	---	--	--	--	---	--	--	--

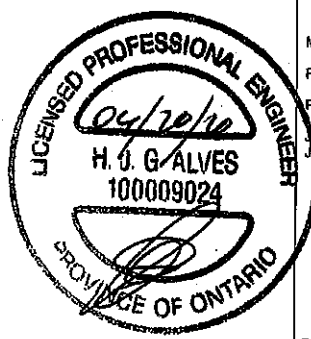

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408163	T1	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2018 Mtek Industries, Inc. Fri Apr 17 08:46:35 2020 Page 2
ID:KIHNL7kIAuBVUgBrpQW7E8zls6v-tmv3EgeadlkXgouTINYXUUGDwL2ldw 1K2addzPX

PLATES (table in inches)


JT	TYPE	PLATES	W	LEN	Y	X
V	BMV+u	4MT20	3.0	6.0		
Y	BMV1+p	MY20	3.0	6.0		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
D	5-10-8	-584	-584	---	FRONT	VERT	TOTAL	---	C1
F	15-11-8	-178	-178	---	FRONT	VERT	TOTAL	---	C1
G	17-11-12	-178	-178	---	FRONT	VERT	TOTAL	---	C1
I	25-0-8	-584	-584	---	FRONT	VERT	TOTAL	---	C1
N	25-11-12	-38	-38	---	FRONT	VERT	TOTAL	---	C1
P	25-11-12	-38	-38	---	FRONT	VERT	TOTAL	---	C1
R	19-11-12	-38	-38	---	FRONT	VERT	TOTAL	---	C1
S	15-11-8	-38	-38	---	FRONT	VERT	TOTAL	---	C1
T	11-11-4	-38	-38	---	FRONT	VERT	TOTAL	---	C1
V	5-11-4	-38	-38	---	FRONT	VERT	TOTAL	---	C1
X	1-11-4	-38	-38	---	FRONT	VERT	TOTAL	---	C1
Z	7-11-4	-178	-178	---	FRONT	VERT	TOTAL	---	C1
AA	9-11-4	-178	-178	---	FRONT	VERT	TOTAL	---	C1
AB	11-11-4	-178	-178	---	FRONT	VERT	TOTAL	---	C1
AC	13-11-4	-178	-178	---	FRONT	VERT	TOTAL	---	C1
AD	19-11-12	-178	-178	---	FRONT	VERT	TOTAL	---	C1
AE	21-11-12	-178	-178	---	FRONT	VERT	TOTAL	---	C1
AF	23-11-12	-178	-178	---	FRONT	VERT	TOTAL	---	C1
AG	3-11-4	-38	-38	---	FRONT	VERT	TOTAL	---	C1
AH	7-11-4	-38	-38	---	FRONT	VERT	TOTAL	---	C1
AI	9-11-4	-38	-38	---	FRONT	VERT	TOTAL	---	C1
AJ	13-11-4	-38	-38	---	FRONT	VERT	TOTAL	---	C1
AK	17-11-12	-38	-38	---	FRONT	VERT	TOTAL	---	C1
AL	21-11-12	-38	-38	---	FRONT	VERT	TOTAL	---	C1
AM	23-11-12	-38	-38	---	FRONT	VERT	TOTAL	---	C1
AN	27-11-12	-38	-38	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

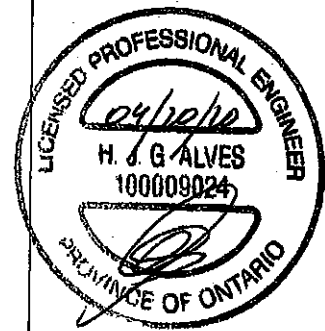


Structural component only
DWG# T-2006468

7/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408163	T1Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Fri Apr 17 08:46:38 2020 Page 1
 ID:KIHNL7kIAuBYUgBrpQW7E8zls6y-LzTSS0elCcsOlmTts43m0hpSgkKgM5c8G_0893zPtxH
 33-2-8
 Scale = 1:52.8

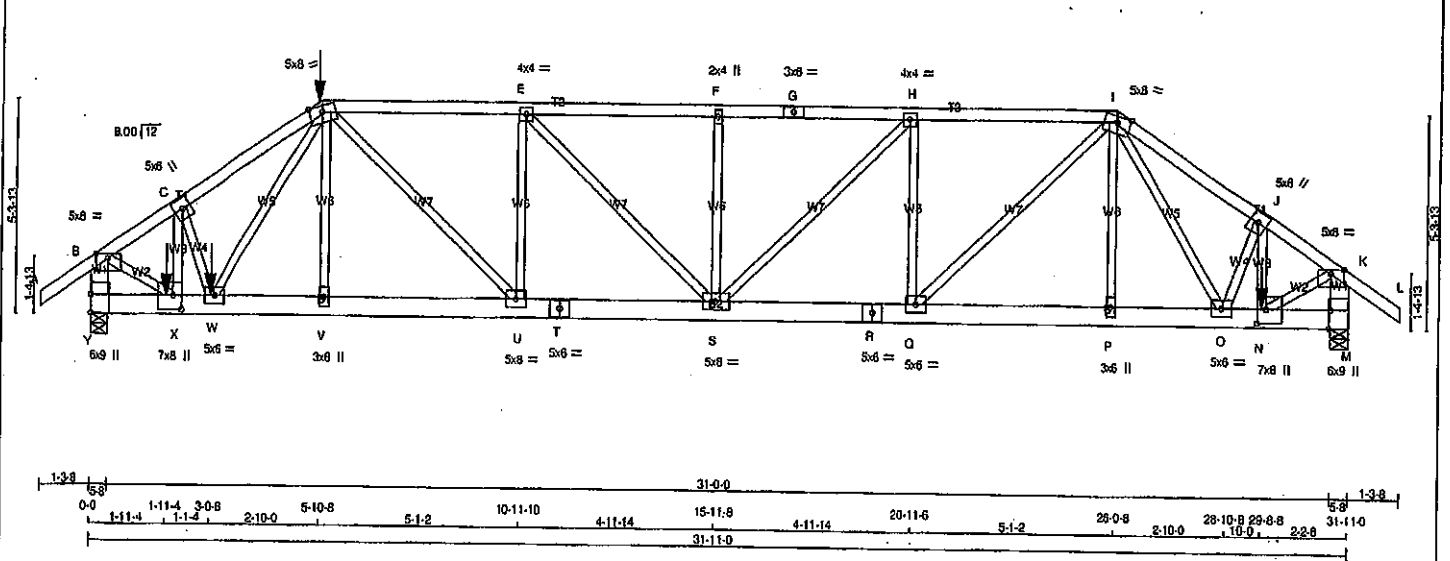

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DRY
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
Y - B	2x6	DRY	No.2
M - K	2x6	DRY	No.2
Y - T	2x6	DRY	No.2
T - R	2x6	DRY	No.2
R - M	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122'X3') SPIRAL NAILS		
A-D 1	12	SIDE(61.0)
D-G 1	12	SIDE(61.0)
G-I 1	12	TOP
I-L 1	12	TOP
Y-B 2	12	TOP
M-K 2	12	TOP
BOTTOM CHORDS: (0.122'X3') SPIRAL NAILS		
Y-T 2	3	SIDE(915.6)
T-R 2	12	TOP
R-M 2	3	SIDE(915.6)
WEBS: (0.122'X3') SPIRAL NAILS		
2x3 1	6	
C-X 1	2	
J-N 1	2	SIDE(391.7)

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMWV-p	MT20	5.0	8.0	1.25	4.00
C TMWV-w	MT20	5.0	8.0		
D TMWV-m	MT20	5.0	8.0	Edge	
E TMWV-w	MT20	4.0	4.0		
F TMWV-w	MT20	2.0	4.0		
G TS-1	MT20	3.0	8.0		
H TMWV-w	MT20	4.0	4.0		
I TMWV-m	MT20	5.0	8.0	Edge	
J TMWV-w	MT20	5.0	8.0		
K TMWV-p	MT20	5.0	8.0	1.25	4.00
M BMV1-w	MT20	6.0	8.0	Edge	0.50
N BMWV-w	MT20	7.0	8.0	4.25	2.50
O, C, U, W					
P BMWV-w	MT20	5.0	8.0		
R BS-1	MT20	5.0	8.0		
S BMWV-w	MT20	5.0	8.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
Y	4869	0	4869	0	0
M	6873	0	6873	0	0

UNFACTORED REACTIONS					
	1ST LOASE	SNOW	LIVE	PERM. LIVE	WIND
JT	COMBINED	3433	2308 / 0	0 / 0	0 / 0
Y		3433	2308 / 0	0 / 0	1126 / 0
M		4850	3240 / 0	0 / 0	1610 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Y, M

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.67 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING					
TOTAL LOAD CASES: (4)					
CHORDS					
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS
FR-TO					
A-B	0 / 35	-91.8	-91.8	0.07 (1)	10.00
B-C	-4946 / 0	-91.8	-91.8	0.11 (1)	4.27
C-D	-5328 / 0	-91.8	-91.8	0.22 (1)	4.05
D-E	-4737 / 0	-91.8	-91.8	0.30 (1)	4.18
E-F	-5022 / 0	-91.8	-91.8	0.31 (1)	4.08
F-G	-5022 / 0	-91.8	-91.8	0.31 (1)	4.08
G-H	-5022 / 0	-91.8	-91.8	0.30 (1)	4.18
H-I	-4787 / 0	-91.8	-91.8	0.27 (1)	3.76
I-J	-6115 / 0	-91.8	-91.8	0.30 (1)	3.67
J-K	-6704 / 0	-91.8	-91.8	0.18 (1)	3.67
K-L	0 / 35	-91.8	-91.8	0.07 (1)	10.00
Y-B	-4819 / 0	0.0	0.0	0.17 (1)	6.60
M-K	-6483 / 0	0.0	0.0	0.23 (1)	5.84
Y-X	0 / 0	-18.5	-18.5	0.02 (1)	10.00
X-W	0 / 4124	-18.5	-18.5	0.46 (1)	10.00
W-V	0 / 3860	-18.5	-18.5	0.45 (1)	10.00
V-U	0 / 3867	-18.5	-18.5	0.32 (1)	10.00
U-T	0 / 4738	-18.5	-18.5	0.34 (1)	10.00
T-S	0 / 4738	-18.5	-18.5	0.34 (1)	10.00
S-R	0 / 4787	-18.5	-18.5	0.35 (1)	10.00
R-Q	0 / 4787	-18.5	-18.5	0.35 (1)	10.00
Q-P	0 / 3961	-18.5	-18.5	0.31 (1)	10.00
P-O	0 / 3956	-18.5	-18.5	0.33 (1)	10.00
O-N	0 / 5579	-18.5	-18.5	0.68 (1)	10.00
N-M	0 / 0	-18.5	-18.5	0.32 (1)	10.00

FACTORED CONCENTRATED LOADS (LBS)					
JT	LOC.	LC1	MAX.	MAX+	FACE
D	5-10-8	-399	-399	---	BACK
N	29-8-8	-5011	-5011	---	BACK
W	3-8-8	-2525	-2525	---	BACK
X	1-11-4	-38	-38	---	BACK

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(85 % OF 31.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.06")
 CALCULATED VERT. DEFL.(LL) = L/989 (0.11")
 ALLOWABLE DEFL.(TL) = L/360 (1.06")
 CALCULATED VERT. DEFL.(TL) = L/989 (0.20")

CSI: TC=0.31/1.00 (E-F:1), BC=0.68/1.00 (N-O:1), WB=0.76/1.00 (K-N:1), SS=0.25/1.00 (N-O:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

GRIP= 0.87 (B) (INPUT = 0.90)
 METAL= 0.72 (K) (INPUT = 1.00)

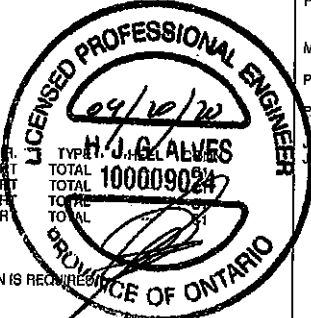

Structural component only
 DWG# T-2006469

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408163	T1Z	1	2	GREEN PARK HOMES	


Tamarack Roof Truss, Burlington

Version 8.310 S Oct 28 2019 Mitek Industries, Inc. Fil Apr 17 08:46:38 2020 Page 2
ID:KIHN1 7kAuBVUpBrpQW7E8zls6y-LzTSS0elCcsOImTIs43m0hpSgkKqM5c8G o893zPjXH

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
T	BS-t	MT20	5.0	6.0		
V	BMW+w	MT20	3.0	6.0		
X	BMWV+t	MT20	7.0	8.0	4.25	2.50
Y	BMV1+t	MT20	6.0	9.0	5.50	

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

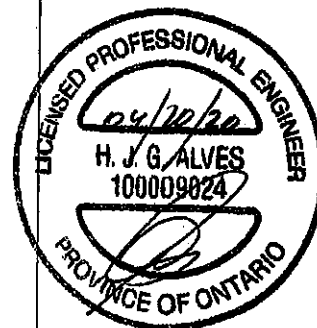

Structural component only
DWG# T-2006469

7/2



DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
<u>BEARINGS</u>							
	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
JT	1885	0	1885	0	0	5-8	5-8
R	1885	0	1885	0	0	5-8	5-8
L	1885	0	1885	0	0	5-8	5-8

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, L

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.12 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

TOTAL LOAD CASES: (4)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF RCBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.08")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.10")
ALLOWABLE DEFL.(TL) = $L/360$ (1.08")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.19")

CSI: TC=0.47/1.00 (D-E:1), BC=0.41/1.00 (N-P:1),
WB=0.77/1.00 (I-L:1), SSI=0.23/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)		SHEAR		SECTION
	(PSI)		(PLI)		(PLI)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	618	354	1667	788	1987 1858

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

J1 GRIP = 0.86 (D) (INPUT = 0.90)
J2 METAL = 0.73 (C) (INPUT = 1.00)



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408163	T4	11	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:46:40 2020 Page 1
ID:KIHNL?kIaUvBVUGBrpQW7E8zls6y-EkiyHNhoSNpmNnR5w8BX_4IMmZlxAJAcMLqzPIXD

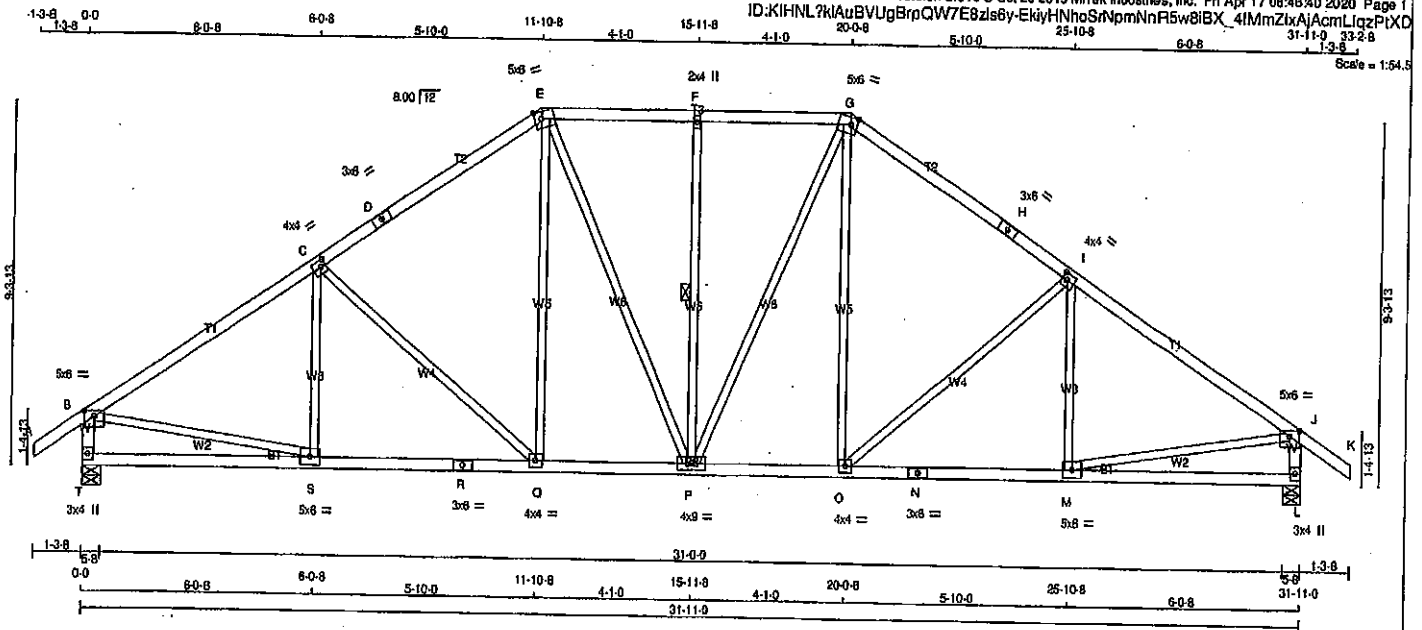

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
T - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
T - R	2x4	DRY	No.2
R - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

PLATES (Table is in inches)				
JT TYPE	PLATES	W	LEN Y	X
B TMVW-p	MT20	5.0	6.0	1.75 3.00
C TMVW-1	MT20	4.0	4.0	2.00 1.50
D TS-1	MT20	3.0	6.0	
E TTWW-m	MT20	5.0	6.0	2.25 2.00
F TMVW-w	MT20	2.0	4.0	
G TTWW-m	MT20	5.0	6.0	2.25 2.00
H TS-1	MT20	3.0	6.0	
I TMVW-1	MT20	4.0	4.0	2.00 1.50
J TMVW-p	MT20	5.0	6.0	1.75 3.00
L BMV1-p	MT20	3.0	4.0	
M BMVW-1	MT20	5.0	6.0	
N BS-1	MT20	3.0	6.0	
O BMVW-1	MT20	4.0	4.0	
P BMVW-1	MT20	4.0	4.0	
Q BMVW-1	MT20	4.0	4.0	
R BS-1	MT20	3.0	6.0	
S BMVW-1	MT20	5.0	6.0	
T BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
T	1885	0	1885	0	0	5-8	5-8	5-8	5-8
L	1885	0	1885	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
T	1331	887/0	0/0	0/0	0/0	444/0	0/0
L	1331	887/0	0/0	0/0	0/0	444/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.16 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO				FR-TO			
A-B	0/35	-91.8	-91.8 0.12 (1)	10.00	S-C	-194/35	0.09 (1)
B-C	-2097/0	-91.8	-91.8 0.53 (1)	4.16	C-Q	-420/0	0.53 (1)
C-D	-1790/0	-91.8	-91.8 0.48 (1)	4.48	Q-E	0/369	0.08 (1)
D-E	-1790/0	-91.8	-91.8 0.48 (1)	4.48	E-P	0/280	0.06 (1)
E-F	-1576/0	-91.8	-91.8 0.21 (1)	5.05	P-F	-449/0	0.26 (1)
F-G	-1576/0	-91.8	-91.8 0.21 (1)	5.05	P-G	0/280	0.06 (1)
G-H	-1790/0	-91.8	-91.8 0.48 (1)	4.48	O-G	0/369	0.08 (1)
H-I	-1790/0	-91.8	-91.8 0.48 (1)	4.48	O-I	-420/0	0.53 (1)
I-J	-2097/0	-91.8	-91.8 0.53 (1)	4.16	M-I	-194.35	0.09 (1)
J-K	0/35	-91.8	-91.8 0.12 (1)	10.00	B-S	0/1803	0.41 (1)
T-B	-1839/0	0.0	0.0 0.19 (1)	6.18	M-J	0/1803	0.41 (1)
L-J	-1839/0	0.0	0.0 0.19 (1)	6.18			
T-S	0/0	-18.5	-18.5 0.18 (4)	10.00			
S-R	0/1775	-18.5	-18.5 0.38 (1)	10.00			
R-Q	0/1775	-18.5	-18.5 0.38 (1)	10.00			
Q-P	0/1461	-18.5	-18.5 0.29 (1)	10.00			
P-O	0/1461	-18.5	-18.5 0.29 (1)	10.00			
O-N	0/1775	-18.5	-18.5 0.38 (1)	10.00			
N-M	0/1775	-18.5	-18.5 0.38 (1)	10.00			
M-L	0/0	-18.5	-18.5 0.18 (4)	10.00			

TOTAL WEIGHT = 11 X 151 = 1658 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.06")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (1.06")
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.53/1.00 (B-C:1), BC=0.36/1.00 (Q-S:1),
WB=0.53/1.00 (C-Q:1), SSI=0.22/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

SI GRIP= 0.84 (B) (INPUT = 0.90)
SI METAL= 0.57 (N) (INPUT = 1.00)

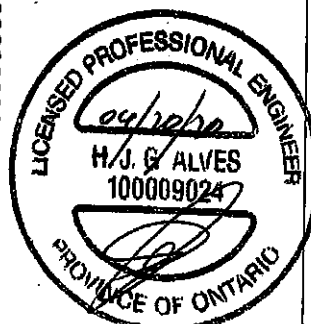

Structural component only
DWG# T-2006472

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408163	T5	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

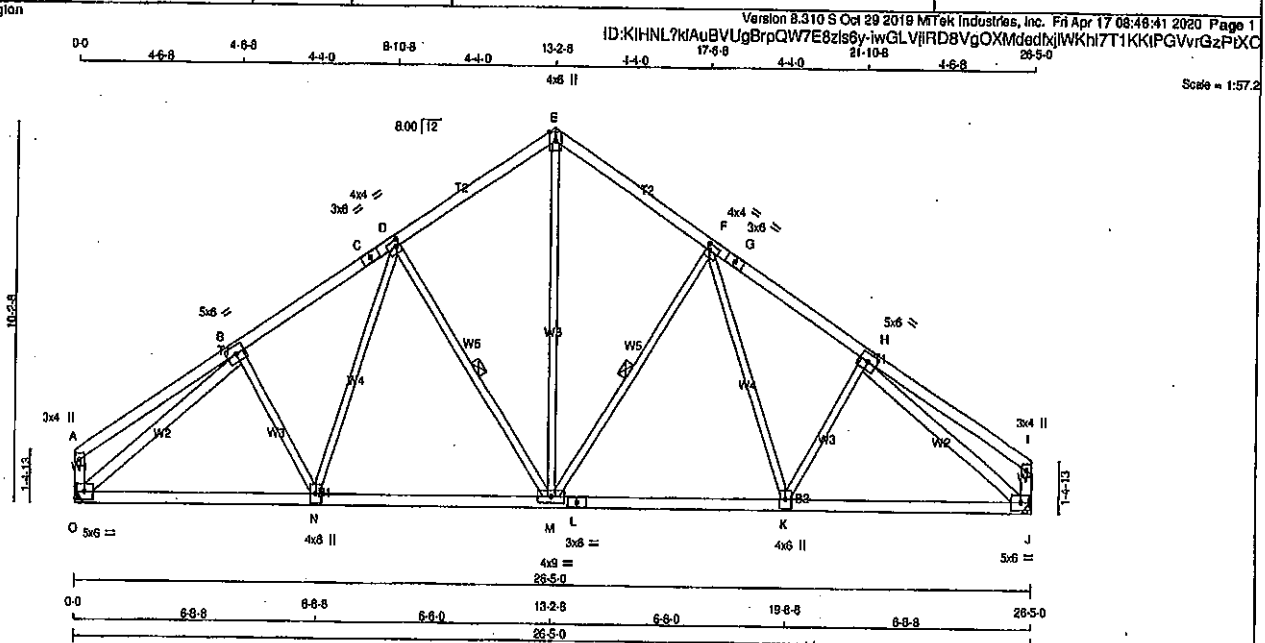

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
O - A	2x4	DRY	No.2
J - I	2x4	DRY	No.2
O - L	2x4	DRY	No.2
L - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
O - B	2x4	DRY	No.2
H - J	2x4	DRY	No.2

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UP
O	1456	0	0
J	1456	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT O, J. MINIMUM BEARING LENGTH AT JOINT O = 3-8, JOINT J = 3-8.

UNFACTORED REACTIONS

1ST CASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED
O	1030 678 / 0
J	1030 678 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.05 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.


1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-M, D-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORIZ. LOAD (PLF)
A-B	0 / 21	-91.8	-91.8
B-C	-1580 / 0	-91.8	-91.8
C-D	-1580 / 0	-91.8	-91.8
D-E	-1198 / 0	-91.8	-91.8
E-F	-1198 / 0	-91.8	-91.8
F-G	-1580 / 0	-91.8	-91.8
G-H	-1580 / 0	-91.8	-91.8
H-I	0 / 21	-91.8	-91.8
O-A	-184 / 0	0.0	0.0
J-I	-184 / 0	0.0	0.0
O-N	0 / 1361	-18.5	-18.5
N-M	0 / 1248	-18.5	-18.5
M-L	0 / 1248	-18.5	-18.5
L-K	0 / 1248	-18.5	-18.5
K-J	0 / 1361	-18.5	-18.5

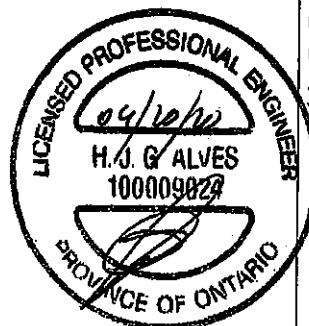

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.88")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.05")
ALLOWABLE DEFL. (TL) = $L/360$ (0.88")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.11")

CSI: TC=0.23/1.00 (H-I), BC=0.32/1.00 (J-K), WB=0.79/1.00 (H-J), SS=0.16/1.00 (H-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 768 1987 1858

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.88 (M) (INPUT = 0.90)
JSI METAL= 0.46 (H) (INPUT = 1.00)


Structural component only
DWG# T-2006473

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408163	T6	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:46:43 2020 Page 1
ID:KIHNL7kIAuBVUg8rpQW7EBzls6y-aJOSwPkhmIOrV0m2hPpAcRzYVPvAZ_7v9zPiXA

Scale = 1:29.0

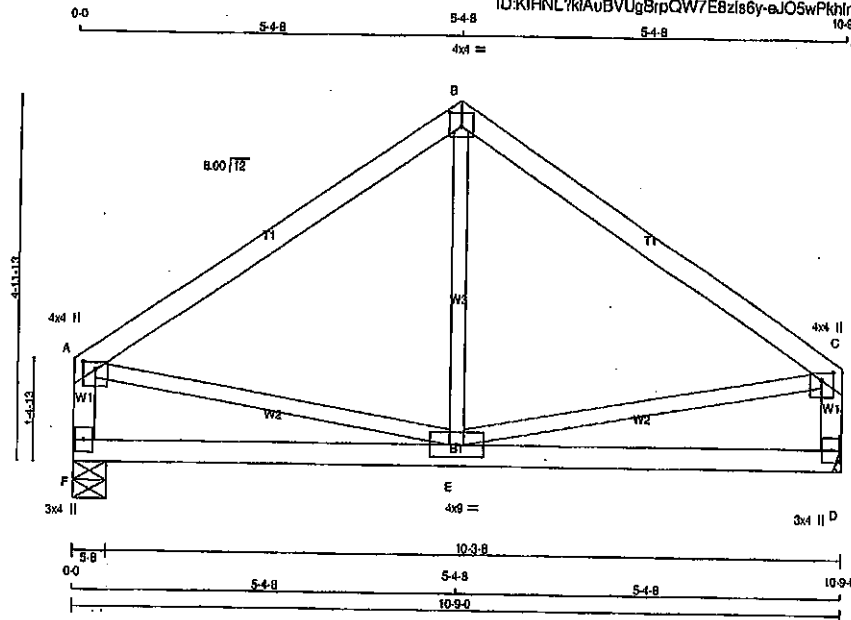

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DRY
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
F - A	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y
A	TMVW+p	MT20	4.0	4.0	1.25
B	TTW+p	MT20	4.0	4.0	2.25
C	TMVW+p	MT20	4.0	4.0	1.25
D	BMV1+p	MT20	3.0	4.0	
E	BMVWW+1	MT20	4.0	9.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	DOWN	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX
F	593	0	0	593	0	0	5-8	5-8	
D	593	0	0	593	0	0	MECHANICAL		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	419	275 / 0	0 / 0	0 / 0	0 / 0	0 / 0	144 / 0	0 / 0
D	419	275 / 0	0 / 0	0 / 0	0 / 0	0 / 0	144 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FORCE (LBS)	MAX. CS1 (LC)	MAX. CS1 (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	-428 / 0	-91.8	-91.8	0.34 (1)	E-B	-20 / 65	0.03 (4)
B-C	-428 / 0	-91.8	-91.8	0.34 (1)	A-E	0 / 362	0.08 (1)
F-A	-554 / 0	0.0	0.0	0.08 (1)	E-C	0 / 362	0.08 (1)
D-C	-554 / 0	0.0	0.0	0.08 (1)			
F-E	0 / 0	-18.5	-18.5	0.15 (4)			
E-D	0 / 0	-18.5	-18.5	0.15 (4)			

TOTAL WEIGHT = 2 X 41 = 83 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
-PART 9 OF CBC 2018, OBC 2012, ABC 2019
-PART 9 OF OBC 2012 (2019 AMENDMENT)
-CSA 088-09, CSA 088-14
-TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.36")
CALCULATED VERT. DEFL.(LL) = $L/899$ (0.01")
ALLOWABLE DEFL.(TL) = $L/360$ (0.36")
CALCULATED VERT. DEFL.(TL) = $L/899$ (0.02")

CS1: TC=0.34/1.00 (B-C:1), BC=0.15/1.00 (D-E:4), WB=0.08/1.00 (C-E:1), SSI=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1838

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.45 (C) (INPUT = 0.90)
JSI METAL = 0.13 (C) (INPUT = 1.00)

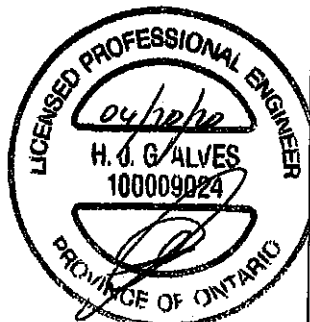

Structural component only
DWG# T-2006474

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408163	T7S	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 6 Oct 2019 MTEK Industries, Inc. Fri Apr 17 08:46:44 2020 Page 1
ID:KIHNL?kIAuBVUgBrpQW7E8z56y6VvT7ikJV3IFF74CKIDeLN8p4zBIErFJ5DkZRbzPtX9

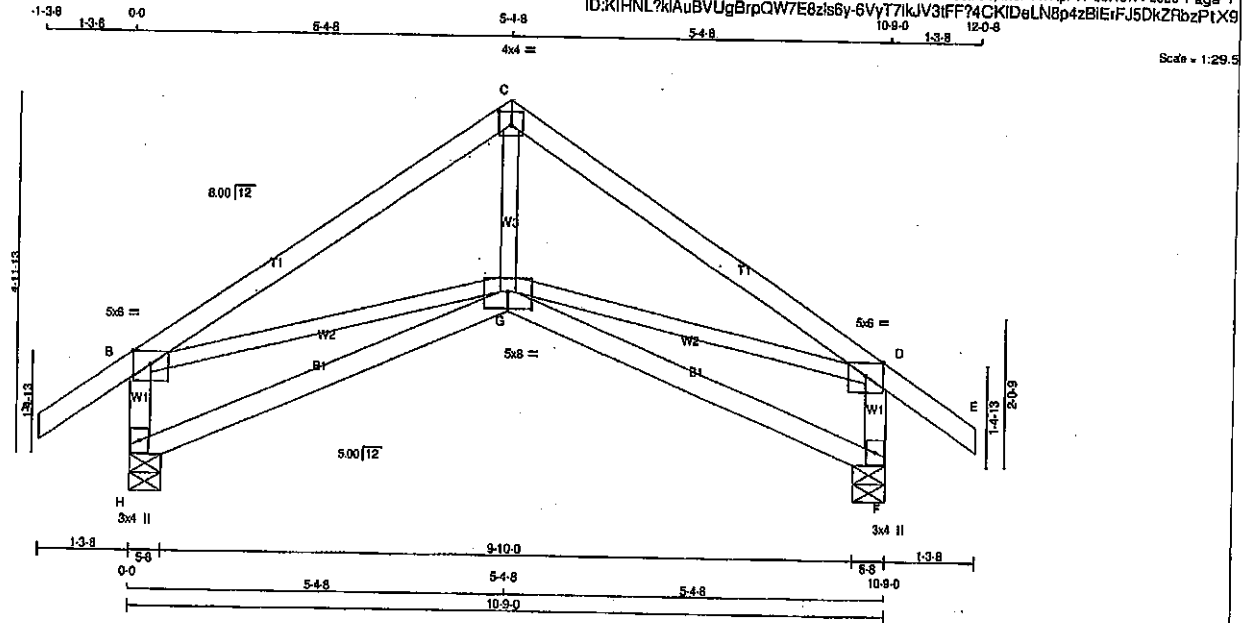

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
F - D	2x4	DRY	No.2
H - G	2x4	DRY	No.2
G - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	Edge	
C	TTW-p	MT20	4.0	4.0	2.25	2.00
D	TMVW-p	MT20	5.0	6.0	Edge	
F	BMV1-p	MT20	3.0	4.0		
G	BBWW-p	MT20	5.0	8.0	2.75	4.00
H	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	GROSS REACTION	GROSS REACTION	DOWN	UP	BRG
H	719	0	719	0	5-8
F	718	0	719	0	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
H	508	345/0	0/0	0/0	0/0	161/0	0/0
F	506	345/0	0/0	0/0	0/0	161/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	FORCE (LBS)	MEMB.	FORCE (LBS)
FR-TO		FR-TO	
A-B	0/35	G-C	0/323
B-C	-735/0	B-G	0/822
C-D	-735/0	G-D	0/822
D-E	0/35		
H-B	-889/0		
F-D	-889/0		
H-G	0/0		
G-F	0/0		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPC 2011, TPC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.35/1.00 (B-C:1), BC=0.16/1.00 (G-H:4), WB=0.14/1.00 (B-G:1), SS=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSD) (PLD) (PLD)
MAX MIN MAX MIN MAX MIN
MT20 610 354 1667 789 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.54 (C) (INPUT = 0.80)
JSI METAL = 0.17 (D) (INPUT = 1.00)

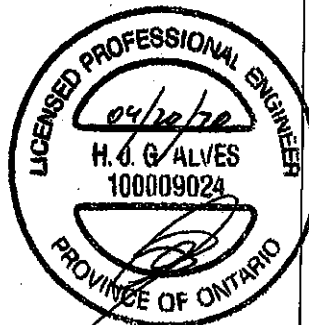


Structural component only
DWG# T-2008475

JOB NAME 408163	TRUSS NAME T8	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 25 2019 Mitek Industries, Inc. File Apr 17 14:14:48 2020 Page 1
ID: KIHNL7kIAuBVUGBrpQW7E8z66y-mNKqMOyOu_rjm7UJRMc7KOC9iACD8rdGx8JhzPojb

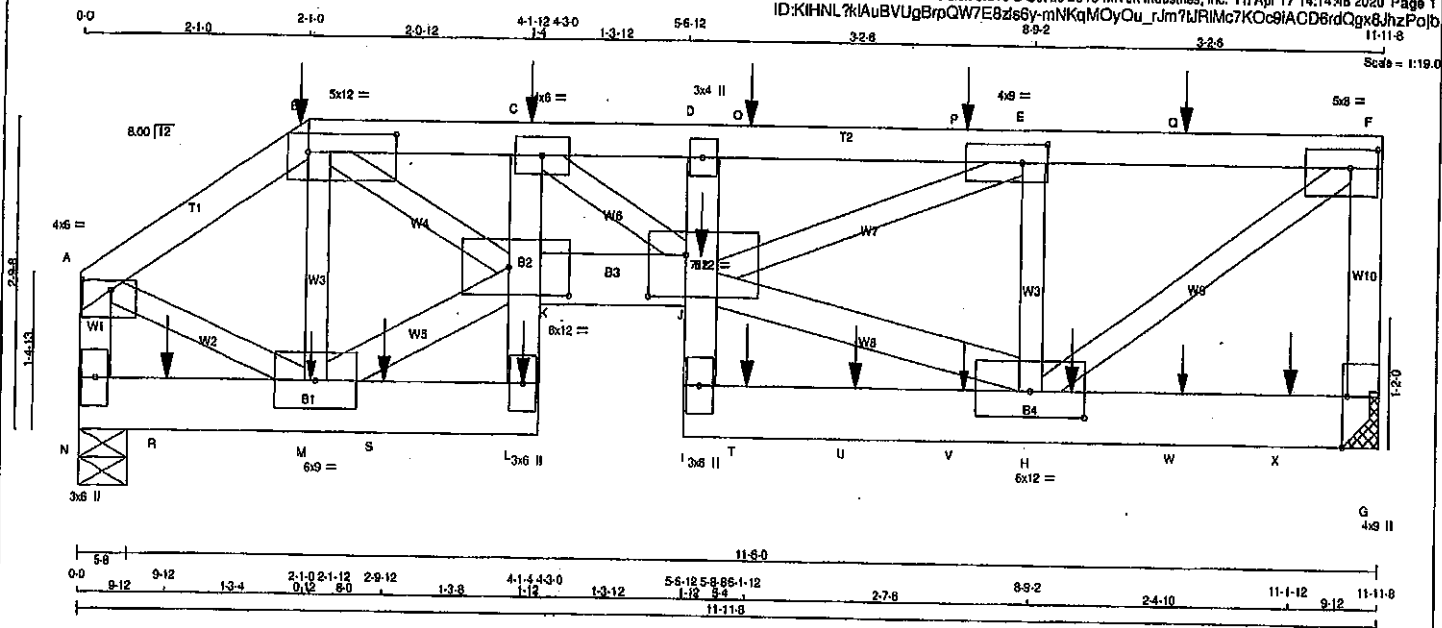

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	No.2 SPF
B - F	2x4	DRY	No.2 SPF
G - F	2x4	DRY	No.2 SPF
N - A	2x4	DRY	No.2 SPF
N - L	2x8	DRY	No.2 SPF
L - C	2x4	DRY	No.2 SPF
K - J	2x6	DRY	No.2 SPF
I - D	2x4	DRY	No.2 SPF
I - G	2x6	DRY	No.2 SPF
ALL WEBS EXCEPT	2x3	DRY	No.2 SPF
M - K	2x4	DRY	No.2 SPF
J - H	2x4	DRY	No.2 SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-B	12	SIDE (61.0)
B-F	12	SIDE (61.0)
F-G	12	TOP
N-A	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
N-L	12	SIDE (61.0)
K-J	12	SIDE (61.0)
I-G	12	SIDE (183.1)
L-C	12	SIDE (28.4)
D-I	12	SIDE (318.3)
WEBS: (0.122"x3") SPIRAL NAILS		
E-H	4	SIDE (192.0)
2x3	6	
2x4	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-p	MT20	4.0	6.0	1.00	3.25
B	TTWW-1	MT20	5.0	12.0	2.00	9.75
C	TMVW-1	MT20	4.0	6.0		
D	TMVW-p	MT20	3.0	4.0		
E	TMVW-1	MT20	4.0	6.0	2.00	2.75
F	TMVW-1	MT20	5.0	8.0	2.00	3.00
G	BMVW-1	MT20	4.0	6.0	Edge	0.50
H	BMVWW-1	MT20	8.0	12.0	2.75	8.00
I	BMVW-p	MT20	3.0	6.0		
J	BMVWW-1	MT20	7.0	12.0	4.50	4.00
K	BMVW-1	MT20	6.0	12.0	3.00	6.75
L	BMVW-p	MT20	3.0	6.0		
M	BMVWW-1	MT20	6.0	9.0		
N	BMVW-1	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UPLIFT
G	5030	0	0
N	4034	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 4.0.

UNFACTORED REACTIONS

1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
G	3552	2369.0	0.0	0.0	0.0	1193.0	0.0
N	2846	1809.0	0.0	0.0	0.0	936.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
A-B	-3843.0	-91.8	-91.8
B-C	-9543.0	-91.8	-91.8
C-D	-11672.0	-91.8	-91.8
D-O	-11175.0	-91.8	-91.8
O-P	-11175.0	-91.8	-91.8
P-E	-11175.0	-91.8	-91.8
E-Q	-5097.0	-91.8	-91.8
Q-F	-5097.0	-91.8	-91.8
F-G	-4076.0	0.0	0.0
N-A	-3665.0	0.0	0.0

WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
M-B	-2179.0	0.19	0.19
C-J	0.72246	0.28	0.28
H-F	-2869.0	0.25	0.25
H-F	0.76454	0.80	0.80
A-M	0.73602	0.43	0.43
M-K	0.73191	0.28	0.28
B-K	0.77537	0.93	0.93
J-H	0.74983	0.44	0.44
J-E	0.76492	0.80	0.80

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TOTAL	HEEL	CON.
B	2-1-0	-94	-94	-94	BACK	VERT	...	...	...
C	4-1-12	-4	-4	-4	BACK	VERT	...	...	...
H	9-1-12	-1438	-1438	-1438	FRONT	VERT	...	...	...
J	5-8-8	-1446	-1446	-1446	FRONT	VERT	...	...	...
L	4-1-4	-581	-581	-581	FRONT	VERT	...	...	...
L	4-1-4	-10	-10	-10	BACK	VERT	...	...	...
M	2-1-12	-1	-1	-1	BACK	VERT	...	...	...
O	6-1-12	-4	-4	-4	BACK	VERT	...	...	...
P	8-1-12	-4	-4	-4	BACK	VERT	...	...	...

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.40")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (0.40")
CALCULATED VERT. DEFL.(TL) = L/558 (0.28")

CSI: TC=0.63/1.00 (D-E-1), BC=0.65/1.00 (J-K-1),
WB=0.93/1.00 (B-K-1), SS=0.32/1.00 (G-H-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1967 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (K) (INPUT = 0.90)
JSI METAL= 0.73 (K) (INPUT = 1.00)

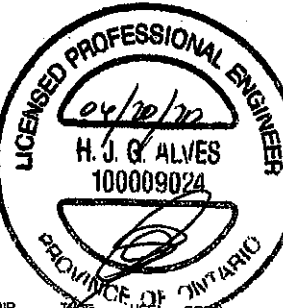

Structural component only 1/2
DWG# T-2006476

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408163	T8	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Fil Apr 17 14:14:48 2020 Page 2

ID:KIHNL7KIAuBVUqBmQW7E8zls6y-mNKoMCvQu rJm?UJIMc7KQc9IACD6rdQqx8JhzPoib


Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
Q	10-1-12	-4	-4	---	BACK	VERT	TOTAL	---	C1
R	9-12	-702	-702	---	FRONT	VERT	TOTAL	---	C1
S	2-9-12	-574	-574	---	FRONT	VERT	TOTAL	---	C1
T	8-1-12	-6	-6	---	BACK	VERT	TOTAL	---	C1
U	7-1-12	-1438	-1438	---	FRONT	VERT	TOTAL	---	C1
V	8-1-12	-1	-1	---	BACK	VERT	TOTAL	---	C1
W	10-1-12	-1	-1	---	BACK	VERT	TOTAL	---	C1
X	11-1-12	-1439	-1439	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

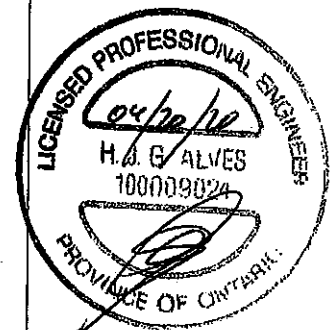


Structural component only
DWG# T-2008476

72

JOB NAME 408165	TRUSS NAME T21	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Road Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2018 MITek Industries, Inc. Fri Apr 17 08:44:20 2020 Page 1
ID:Ovhky48Q0cPQc Y353NoTWzckK0-KoF1vV? Cqkh_s4XuWdiW0BAKwy8Vdn7_qnOx2PzP
31-11-0 33-2-8
Scale = 1:52.8

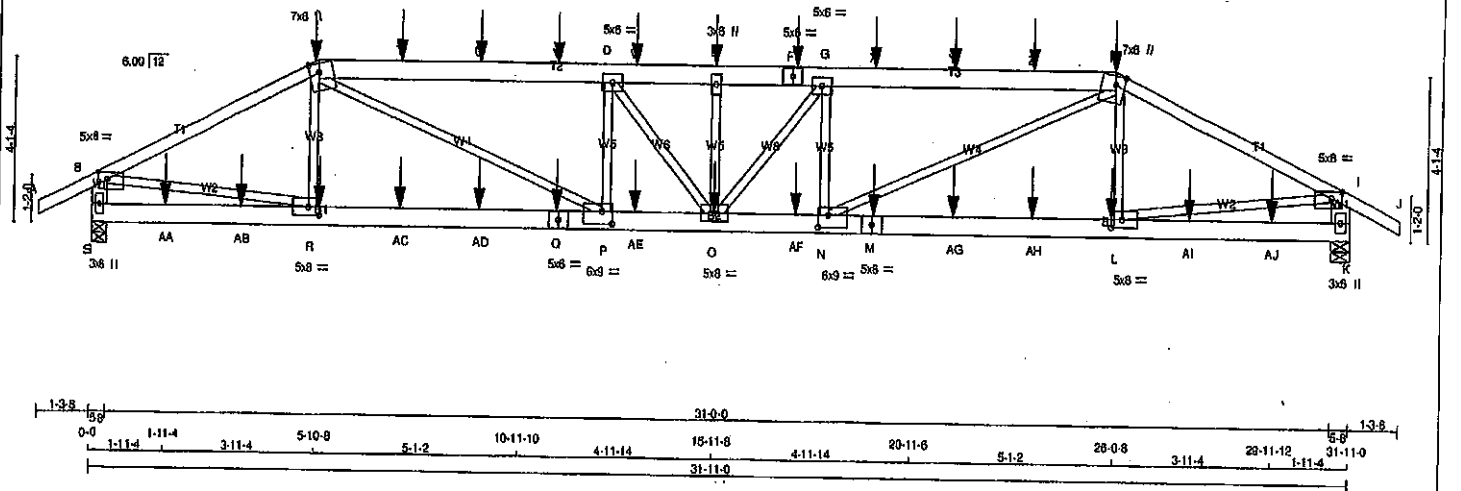

LUMBER			
N. L. G. A. RULES	SIZE	DRY	DESCR.
CHORDS	2x4	DRY	No.2
A - C	2x6	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
S - B	2x6	DRY	No.2
K - I	2x6	DRY	No.2
S - Q	2x8	DRY	No.2
Q - M	2x8	DRY	No.2
M - K	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A - C	12	SIDE(81.0)
H - J	12	SIDE(81.0)
C - F	2	SIDE(183.1)
F - H	2	SIDE(183.1)
S - B	2	TOP
K - I	2	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
S - Q	12	SIDE(183.1)
Q - M	2	SIDE(183.1)
M - K	2	SIDE(183.1)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (tablets in inches)	W	LEN	Y	X
JT TYPE				
B TMWW-p	MT20	5.0	8.0	2.00 3.25
C TTWW+m	MT20	7.0	8.0	2.75 2.75
D TMWW-i	MT20	5.0	8.0	
E TMWW-w	MT20	3.0	8.0	
F TS-i	MT20	5.0	8.0	
G TMWW-i	MT20	5.0	8.0	
H TTWW+m	MT20	7.0	8.0	2.75 2.75
I TMWW-p	MT20	5.0	8.0	2.00 3.25
J BMV1-p	MT20	3.0	8.0	
K BMWW-i	MT20	5.0	8.0	2.50 3.25
M BS-i	MT20	5.0	8.0	
N BMWW-i	MT20	8.0	8.0	3.75 3.00
O BMWW-w	MT20	5.0	8.0	
P BMWW-i	MT20	8.0	8.0	3.75 3.00
Q BS-i	MT20	5.0	8.0	
R BMWW-i	MT20	5.0	8.0	2.50 3.25
S BMV1-p	MT20	3.0	8.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	DOWN	HORIZ	UPLIFT
S 3035	0	3035	0
K 3034	0	3034	0

UNFACTORED REACTIONS			
1ST LCASE	MAX. MIN. COMPONENT REACTIONS		
JT COMBINED	SNOW	LIVE	PERM. LIVE
S 2146	1410 / 0	0 / 0	0 / 0
K 2145	1409 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.07 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING			
TOTAL LOAD CASES: (4)			
CHORDS			
MEMB.	FORCE (LBS)	VERT. LOAD	CS1 (LO)
FR-TO			
A-B	0 / 28	-91.8	-91.8 0.07 (1)
B-C	-4576 / 0	-91.8	-91.8 0.48 (1)
C-T	-6582 / 0	-91.8	-91.8 0.36 (1)
T-U	-6582 / 0	-91.8	-91.8 0.36 (1)
U-V	-6582 / 0	-91.8	-91.8 0.36 (1)
V-D	-6582 / 0	-91.8	-91.8 0.36 (1)
D-W	-6516 / 0	-91.8	-91.8 0.28 (1)
W-E	-6516 / 0	-91.8	-91.8 0.28 (1)
E-F	-6516 / 0	-91.8	-91.8 0.28 (1)
F-G	-6516 / 0	-91.8	-91.8 0.28 (1)
G-X	-6580 / 0	-91.8	-91.8 0.38 (1)
X-Y	-6580 / 0	-91.8	-91.8 0.38 (1)
Y-Z	-6580 / 0	-91.8	-91.8 0.38 (1)
Z-H	-6580 / 0	-91.8	-91.8 0.38 (1)
H-I	-4574 / 0	-91.8	-91.8 0.48 (1)
I-J	0 / 28	-91.8	-91.8 0.07 (1)
S-B	-2972 / 0	0.0	0.0 0.10 (1)
K-I	-2971 / 0	0.0	0.0 0.10 (1)
WEBS			
MEMB.	FORCE (LBS)	MAX. FACTORED	CS1 (LO)
FR-TO			
R-C	-311 / 77	0.04 (1)	
C-P	0 / 2765	0.34 (1)	
P-D	-1060 / 0	0.13 (1)	
D-O	-109 / 0	0.02 (1)	
O-E	0 / 191	0.02 (1)	
E-G	-105 / 0	0.02 (1)	
G-Q	-1059 / 0	0.13 (1)	
Q-N	0 / 2763	0.34 (1)	
N-H	-311 / 77	0.04 (1)	
H-R	0 / 4138	0.51 (1)	
R-I	0 / 4137	0.51 (1)	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CIG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.08")
CALCULATED VERT. DEFL.(LL) = L/999 (0.16")
ALLOWABLE DEFL.(TL) = L/360 (1.08")
CALCULATED VERT. DEFL.(TL) = L/999 (0.30")

CSI: TC=0.48/1.00 (B-C:1), BC=0.47/1.00 (C-P:1), WB=0.51/1.00 (B-R:1), SS=0.20/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PLJ) (PLJ)
MAX MIN MAX MIN MAX MIN
MT20 518 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.54 (R) (INPUT = 0.80)
JSI METAL=0.40 (R) (INPUT = 1.00)

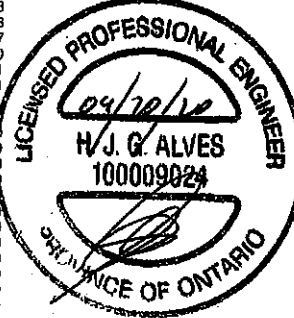

FACTORED CONCENTRATED LOADS (LBS)			
JT	LOC.	LC1	MAX. MAX.
C	5-10-8	-457	---
E	15-11-8	-110	---
F	17-11-12	-110	---
FACE DIR.			
FRONT VERT			
FRONT VERT			
FRONT VERT			

Structural component only 1/2
DWG# T-2006487

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408165	T21	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington


Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Fri Apr 17 08:44:20 2020 Page 2
ID:OvNky48Q0cPQc Y353NoTWzckKo-KoF1vV? Qqkh s4XuWdIWQBAKwy8Vdn7 qnOxzP1ZP

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
H	28-0-8	-457	-457	---	FRONT	VERT	TOTAL	---	C1
L	25-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
M	19-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
O	15-11-8	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Q	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	19-11-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	21-11-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	23-11-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	1-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AB	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AC	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AD	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AE	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AF	17-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	21-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	23-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	27-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	29-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGERMECHANICAL CONNECTION IS REQUIRED.

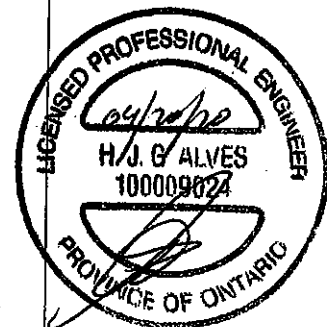


Structural component only
DWG# T-2006487

7/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408165	T21Z	1	2	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Fri Apr 17 08:44:21 2020 Page 1		
				ID:Ovnyk48Q0cPQc_Y353NoTWzKCo-o7pP6r0cB7sYb0(RD862D)HvKByE7sGDubVw0zPlZO		
				31-11-0 33-2-8 1-3-8		
				Scale = 1:52.6		

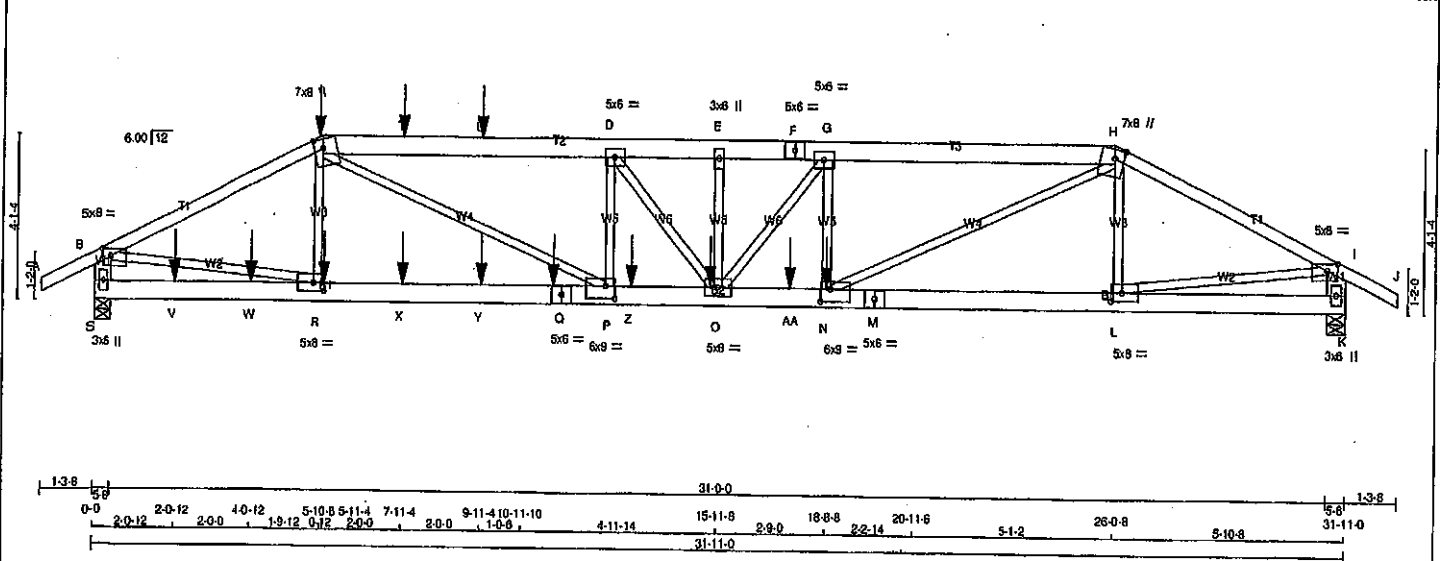

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - F	2x8	DRY	No.2
F - H	2x6	DRY	No.2
H - J	2x4	DRY	No.2
S - B	2x4	DRY	No.2
K - I	2x8	DRY	No.2
S - Q	2x6	DRY	No.2
Q - M	2x6	DRY	No.2
M - K	2x6	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	SIDE (81.0)
H - J	12	TOP
C - F	12	SIDE (81.0)
F - H	12	TOP
S - B	12	TOP
K - I	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S - Q	12	SIDE (183.1)
Q - M	12	SIDE (183.1)
M - K	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	SIDE (300.5)
G - N	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (tablets in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	MTWV-p	MT20	5.0	8.0	2.00	3.25
C	TTWV-m	MT20	7.0	8.0	2.75	2.75
D	MTWV-t	MT20	5.0	8.0		
E	MTWV-w	MT20	3.0	6.0		
F	TS-i	MT20	5.0	6.0		
G	MTWV-t	MT20	5.0	6.0		
H	TTWV-m	MT20	7.0	8.0	2.75	2.75
I	MTWV-p	MT20	5.0	8.0	2.00	3.25
K	BMV1+p	MT20	3.0	6.0		
L	BMWV-t	MT20	5.0	8.0	2.50	3.25
M	BS-i	MT20	5.0	6.0		
N	BMWV-t	MT20	8.0	9.0	3.75	3.00
O	BMWV-w	MT20	5.0	8.0		
P	BMWV-t	MT20	6.0	9.0	3.75	3.00
Q	BS-i	MT20	5.0	6.0		
R	BMWV-t	MT20	5.0	8.0	2.50	3.25
S	BMV1+p	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
S	4661	0	4661	0	0	5-8	5-8	5-8	5-8
K	4115	0	4115	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST CASE		MAX. MIN. COMPONENT REACTIONS		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	DEAD	SOIL
S	3289	2197.0	0.0	0.0	0.0	1092.0	0.0	0.0	0.0
K	2901	1954.0	0.0	0.0	0.0	947.0	0.0	0.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.09 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING		TOTAL LOAD CASES: (4)	
CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORZ. LOAD (LBS)
FR-TO			
A-B	0.728	-91.8	-91.8
B-C	-7526.0	-91.8	-91.8
C-T	-11588.0	-91.8	-91.8
T-U	-11588.0	-91.8	-91.8
U-D	-11588.0	-91.8	-91.8
D-E	-11588.0	-91.8	-91.8
E-F	-11588.0	-91.8	-91.8
F-G	-11588.0	-91.8	-91.8
G-H	-11588.0	-91.8	-91.8
H-I	-6538.0	-91.8	-91.8
I-J	0.0	0.0	0.0
J-K	-4635.0	0.0	0.0
K-L	-4078.0	0.0	0.0
S-V	0.0	-18.5	-18.5
V-W	0.0	-18.5	-18.5
W-R	0.0	-18.5	-18.5
R-X	0.6747	-18.5	-18.5
X-Y	0.6747	-18.5	-18.5
Y-Q	0.6747	-18.5	-18.5
Q-P	0.6747	-18.5	-18.5
P-Z	0.11598	-18.5	-18.5
Z-O	0.11598	-18.5	-18.5
O-AA	0.11803	-18.5	-18.5
AA-N	0.11803	-18.5	-18.5
N-M	0.5878	-18.5	-18.5
M-L	0.5878	-18.5	-18.5
L-K	0.0	-18.5	-18.5

FACTORED CONCENTRATED LOADS (LBS)		FACE		DIR.	
JT	LOC.	LOC.	MAX.	FACE	DIR.
C	5-10-8	-380	-380	BACK	VERT
N	18-8-8	-1854	-1854	BACK	VERT
O	15-9-4	-459	-459	BACK	VERT
Q	11-9-4	-459	-459	BACK	VERT
R	5-11-4	-256	-256	BACK	VERT
T	7-11-4	-33	-33	BACK	VERT
U	9-11-4	-33	-33	BACK	VERT
V	2-0-12	-41	-41	BACK	VERT
W	4-0-12	-61	-61	BACK	VERT
X	7-11-4	-256	-256	BACK	VERT
Y	9-11-4	-256	-256	BACK	VERT
Z	13-9-4	-459	-459	BACK	VERT

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 26.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/360 (1.06")
CALCULATED VERT. DEFL.(LL) = 1/989 (0.29")
ALLOWABLE DEFL.(TL) = 1/360 (1.06")
CALCULATED VERT. DEFL.(TL) = 1/717 (0.53")

CSI: TC=0.75/1.00 (B-C-I), BC=0.94/1.00 (N-O-I), WB=0.84/1.00 (B-R-I), SI=0.23/1.00 (P-R-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1087 788 1987 1856

PLATE PLACEMENT TOL = 0.250 Inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.89 (N) (INPUT = 0.90)
JSI METAL= 0.73 (M) (INPUT = 1.00)

Structural component only 1/2
DWG# T-2006488

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.																														
408165	T21Z	1	2	GREEN PARK HOMES																															
Tamarack Roof Truss, Burlington																																			
Version 8.310 S Oct 29 2019 M/Tek Industries, Inc. Fri Apr 17 08:44:21 2020 Page 2 ID:Ovhtkv48Q0cPQc Y353NoTWzlcKq-a?nPeR0cB7sYb0fIRD862DiHyKBvE7sGDUpVwOzP1ZO																																			
<table border="1"><thead><tr><th colspan="10">FACTORED CONCENTRATED LOADS (LBS)</th></tr><tr><th>JT</th><th>LOC.</th><th>LC1</th><th>MAX</th><th>MAX+</th><th>FACE</th><th>DIR.</th><th>TYPE</th><th>HEEL</th><th>CONN.</th></tr></thead><tbody><tr><td>AA</td><td>17-9-4</td><td>-459</td><td>-459</td><td>...</td><td>BACK</td><td>VERT</td><td>TOTAL</td><td>...</td><td>C1</td></tr></tbody></table> CONNECTION REQUIREMENTS 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.						FACTORED CONCENTRATED LOADS (LBS)										JT	LOC.	LC1	MAX	MAX+	FACE	DIR.	TYPE	HEEL	CONN.	AA	17-9-4	-459	-459	...	BACK	VERT	TOTAL	...	C1
FACTORED CONCENTRATED LOADS (LBS)																																			
JT	LOC.	LC1	MAX	MAX+	FACE	DIR.	TYPE	HEEL	CONN.																										
AA	17-9-4	-459	-459	...	BACK	VERT	TOTAL	...	C1																										
LICENSED PROFESSIONAL ENGINEER 04/20/20 H. A. G. ALVES 100009027 PROVINCE OF ONTARIO Structural component only DWG# T-2006488																																			

JOB NAME 408165	TRUSS NAME T22	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWGNO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2018 MiTek Industries, Inc. Fri Apr 17 08:44:21 2020 Page 1		
1-3.8 0-0 4-8.8 4-0.8 3-10.0 7-10.8 5-5.1 13-3.9 5-3.13 18-7.7 5-5.1 24-0.8 3-10.0 27-10.8 4-0.8 1-3.8 1-3.8 0-0 7-10.8 7-10.8 5-5.1 13-3.9 5-3.13 18-7.7 5-5.1 24-0.8 7-10.8 31-11.0 1-3.8 0-0 31-0.0 31-11.0				ID:1ebEM4Ce92xn94Zv7kFPzmBR3-o7pP6r0cB7sYb0jRD862DjKBKHE1RGDUbVwOzPZO Scale = 1:52.6		

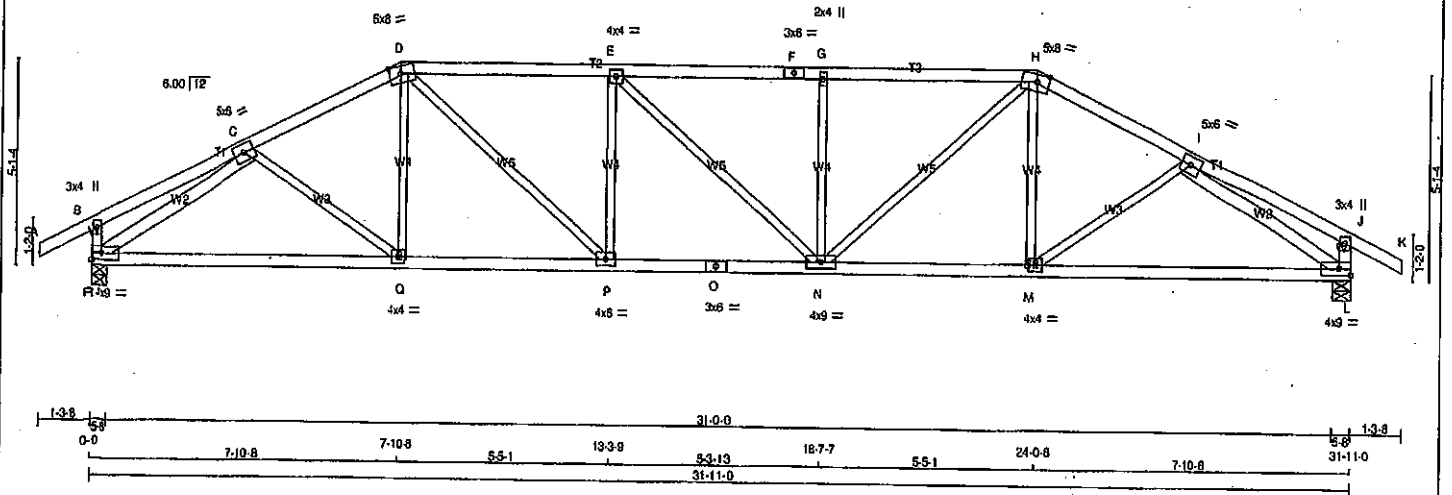

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
R - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
R - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
C	TMWW-1	MT20	5.0	8.0	
D	TTWW-m	MT20	5.0	8.0	2.25 3.50
E	TMWW-1	MT20	4.0	4.0	
F	TS-1	MT20	3.0	6.0	
G	TMW+w	MT20	2.0	4.0	
H	TTWW-m	MT20	5.0	8.0	2.25 3.50
I	TMWW-1	MT20	5.0	8.0	
J	TMV+p	MT20	3.0	4.0	
L	BMVW-1	MT20	4.0	9.0	Edge
M	BMWW-1	MT20	4.0	9.0	
N	BMWW-1	MT20	4.0	9.0	
O	BS-1	MT20	3.0	6.0	
P	BMWW-1	MT20	4.0	6.0	
Q	BMWW-1	MT20	4.0	4.0	
R	BMVW-1	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
	FACTORED	MAXIMUM FACTORED	INPUT	RECORD					
	GROSS REACTION	GROSS REACTION	BRG	BRG					
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
R	1884	0	1884	0	0	5-8	5-8		
L	1884	0	1884	0	0	5-8	5-8		
UNFACTORED REACTIONS									
	1ST LOASE	MAX. MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
R	1330	886 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0		
L	1330	886 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0		
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, L									
BRACING									
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.61 FT.									
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.									
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.									

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	MEMB.
FR-TO					FR-TO				
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	C-Q	0 / 74	0.03 (4)	
B-C	0 / 17	-91.8	-91.8	0.20 (1)	10.00	Q-D	0 / 133	0.04 (4)	
C-D	-2469 / 0	-91.8	-91.8	0.30 (1)	4.12	D-P	0 / 933	0.21 (1)	
D-E	-2693 / 0	-91.8	-91.8	0.54 (1)	3.61	P-E	-534 / 0	0.21 (1)	
E-F	-2691 / 0	-91.8	-91.8	0.53 (1)	3.61	E-N	-2 / 0	0.00 (1)	
F-G	-2691 / 0	-91.8	-91.8	0.53 (1)	3.61	N-G	-533 / 0	0.21 (1)	
G-H	-2691 / 0	-91.8	-91.8	0.53 (1)	3.61	H-N	0 / 931	0.21 (1)	
H-I	-2469 / 0	-91.8	-91.8	0.30 (1)	4.12	M-H	0 / 134	0.04 (4)	
I-J	0 / 17	-91.8	-91.8	0.20 (1)	10.00	M-I	0 / 74	0.03 (4)	
J-K	0 / 28	-91.8	-91.8	0.12 (1)	10.00	R-C	-2666 / 0	0.74 (1)	
R-B	-269 / 0	0.0	0.0	0.03 (1)	7.81	I-L	-2667 / 0	0.74 (1)	
L-J	-269 / 0	0.0	0.0	0.03 (1)	7.81				
R-Q	0 / 2167	-18.5	-18.5	0.49 (1)	10.00				
Q-P	0 / 2194	-18.5	-18.5	0.48 (1)	10.00				
P-O	0 / 2393	-18.5	-18.5	0.53 (1)	10.00				
O-N	0 / 2393	-18.5	-18.5	0.53 (1)	10.00				
N-M	0 / 2184	-18.5	-18.5	0.49 (1)	10.00				
M-L	0 / 2168	-18.5	-18.5	0.49 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 OL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 OL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF NBC 2018, NBC 2012, ABC 2019
 - PART 9 OF NBC 2012 (2019 AMENDMENT)
 - CSA 085-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.08")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.15")
 ALLOWABLE DEFL.(TL) = L/360 (1.08")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.29")

CSK: TC=0.54/1.00 (D-E:1), BC=0.53/1.00 (N-P:1), WB=0.74/1.00 (I-L:1), SS=0.23/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.84 (O) (INPUT = 0.90)
 JSI METAL= 0.84 (O) (INPUT = 1.00)

Structural component only
 DWG# T-2006489

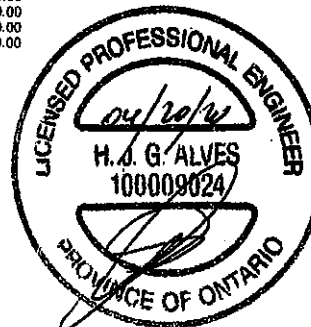

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408165	T23	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 08:44:22 2020 Page 1
ID:1ebEM4Ce92xn94Zv7jkFPizmBR3-GBMoKB1EyR_ODAEv7xLbRGV_jf9yX6PR8K2SqzP1ZN

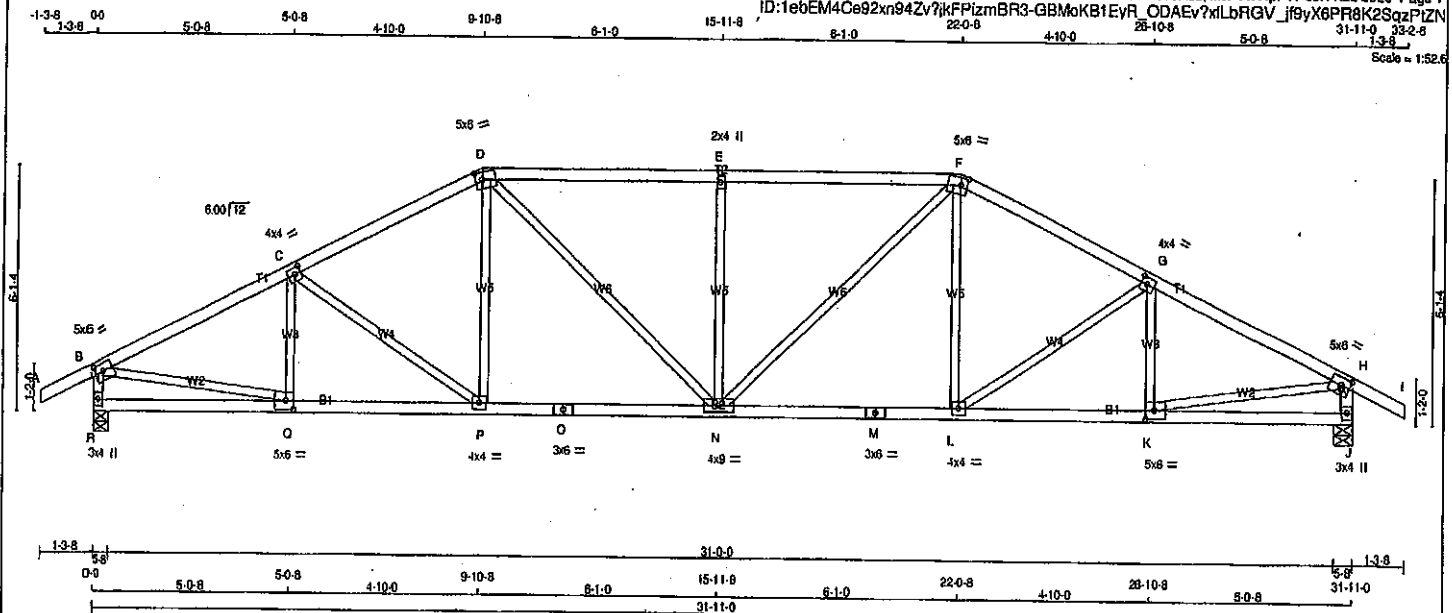

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2		
D - F	2x4	DRY	No.2		
F - I	2x4	DRY	No.2		
R - B	2x4	DRY	No.2		
J - H	2x4	DRY	No.2		
R - O	2x4	DRY	No.2		
O - M	2x4	DRY	No.2		
M - J	2x4	DRY	No.2		
ALL WEBS	2x3	DRY	No.2		
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	6.0	2.25	2.75
C	TMVW-t	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	6.0	2.25	2.00
E	TMVW-t	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	8.0	2.25	2.00
G	TMVW-t	MT20	4.0	4.0	2.00	1.75
H	TMVW-t	MT20	5.0	6.0	2.25	2.75
J	BMV1-p	MT20	3.0	4.0		
K	BMVW-t	MT20	5.0	6.0	2.50	2.50
L	BMVW-t	MT20	4.0	4.0		
M	BS-1	MT20	3.0	6.0		
N	BMVWW-t	MT20	4.0	9.0		
O	BS-1	MT20	3.0	6.0		
P	BMVW-t	MT20	4.0	4.0		
Q	BMVW-t	MT20	5.0	8.0	2.50	2.50
R	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UPLIFT	IN-SX
R	1884	0	1884	0
J	1884	0	1884	0

UNFACTORED REACTIONS							
	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERMLIVE	WIND	DEAD	SOIL
R	1330	888 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0
J	1330	888 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.82 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	UNBRAC	WEBS	MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX
		(LBS)	(PLF)	(LBS)		(LBS)	(LBS)			(LBS)	(PLF)	(LBS)		(LBS)
FR-TO								FR-TO						
A-B	0 / 28	-91.8	-91.8	0.12	(1)	10.00	Q-C	-301 / 0	0.07	(1)				
B-C	-2538 / 0	-91.8	-91.8	0.37	(1)	4.02	C-P	-284 / 0	0.18	(1)				
C-D	-2342 / 0	-91.8	-91.8	0.35	(1)	4.17	P-D	0 / 257	0.08	(1)				
D-E	-2493 / 0	-91.8	-91.8	0.54	(1)	3.82	D-N	0 / 575	0.13	(1)				
E-F	-2493 / 0	-91.8	-91.8	0.54	(1)	3.82	N-E	-685 / 0	0.40	(1)				
F-G	-2342 / 0	-91.8	-91.8	0.35	(1)	4.17	N-F	0 / 575	0.13	(1)				
G-H	-2538 / 0	-91.8	-91.8	0.37	(1)	4.02	L-F	0 / 257	0.06	(1)				
H-I	0 / 28	-91.8	-91.8	0.12	(1)	10.00	L-G	-284 / 0	0.16	(1)				
R-B	-1841 / 0	0.0	0.0	0.19	(1)	6.17	K-G	-301 / 0	0.07	(1)				
J-H	-1841 / 0	0.0	0.0	0.19	(1)	6.17	B-Q	0 / 2323	0.52	(1)				
R-Q	0 / 0	-18.5	-18.5	0.10	(4)	10.00	K-H	0 / 2323	0.52	(1)				
Q-P	0 / 2290	-18.5	-18.5	0.43	(1)	10.00								
P-O	0 / 2077	-18.5	-18.5	0.40	(1)	10.00								
O-N	0 / 2077	-18.5	-18.5	0.40	(1)	10.00								
N-M	0 / 2077	-18.5	-18.5	0.40	(1)	10.00								
M-L	0 / 2077	-18.5	-18.5	0.40	(1)	10.00								
L-K	0 / 2290	-18.5	-18.5	0.43	(1)	10.00								
K-J	0 / 0	-18.5	-18.5	0.10	(4)	10.00								

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2015, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

66% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.06")
CALCULATED VERT. DEFL.(LL) = L/999 (0.13")
ALLOWABLE DEFL.(TL) = L/360 (1.06")
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.54/1.00 (D-E:1), BC=0.43/1.00 (K-L:1), WB=0.52/1.00 (H-K:1), SSI=0.27/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (B) (INPUT = 0.90)

JSI METAL = 0.87 (B) (INPUT = 1.00)

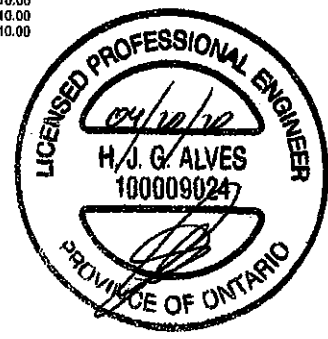


Structural component only
DWG# T-2006490

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408165	T24	1	1	GREEN PARK HOMES	
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. File Apr 17 08:44:22 2020 Page 1
ID:1ebEM4Ce92xn94Zv7jkFPizmBR3-GBMoKB1EyR_ODAEv7xLbRGVpif6yX7PR8K2SqzPZIN

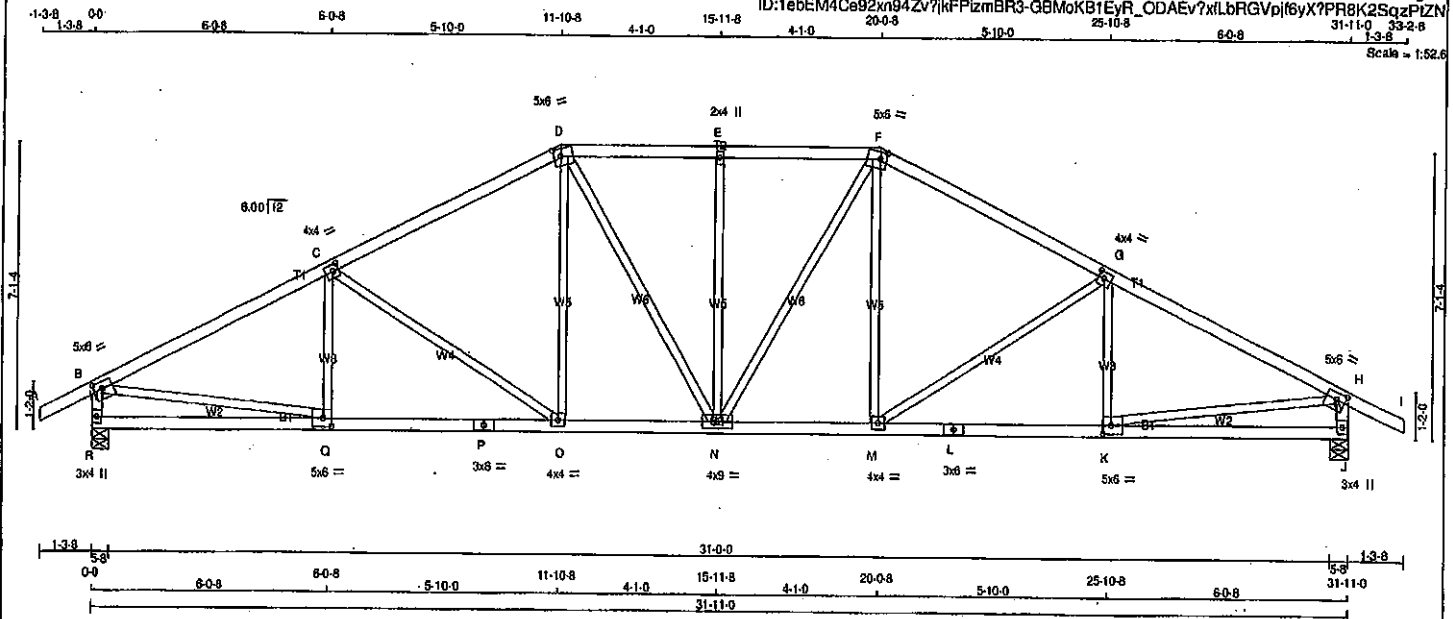

TOTAL WEIGHT = 136 lb
(M/F)

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
P - P	2x4	DRY	No.2
L - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-1	MT20	5.0	6.0	2.00	2.75
C TMWW-1	MT20	4.0	4.0	2.00	1.75
D TTWW-m	MT20	5.0	6.0	2.25	2.00
E TMW-w	MT20	2.0	4.0		
F TTWW-m	MT20	5.0	6.0	2.25	2.00
G TMWW-1	MT20	4.0	4.0	2.00	1.75
H TMVW-1	MT20	5.0	6.0	2.00	2.75
J BMV1+p	MT20	3.0	4.0		
K BMWW-1	MT20	5.0	6.0	2.50	2.50
L BS-1	MT20	3.0	6.0		
M BMWW-1	MT20	4.0	4.0		
N BMWW-1	MT20	4.0	4.0		
O BMWW-1	MT20	4.0	4.0		
P BS-1	MT20	3.0	6.0		
Q BMWW-1	MT20	5.0	6.0	2.50	2.50
R BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
R	1884	0	1884	0	5-8
J	1884	0	1884	0	5-8

UNFACTORED REACTIONS

JT	1ST LOSE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	COMBINED	1330	886 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0
J	COMBINED	1330	886 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.79 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED	MEMB.	MAX. FACTORED
FR-TO	FORCE (LBS)	FR-TO	FORCE (LBS)
A-B	0 / 28	C-C	-212 / 29
B-C	-2579 / 0	D-D	-480 / 0
C-D	-2188 / 0	E-E	0 / 282
D-E	-2088 / 0	F-F	0 / 286
E-F	-2088 / 0	G-G	-451 / 0
F-G	-2188 / 0	H-H	0 / 286
G-H	-2579 / 0	I-I	0 / 362
H-I	0 / 28	J-J	-480 / 0
I-J	-1836 / 0	K-K	-212 / 29
J-K	-1836 / 0	L-L	0 / 2355
K-L	0 / 0	M-M	0 / 2355
L-M	0 / 0	N-N	0 / 0
M-N	0 / 0	O-O	0 / 0
N-O	0 / 0	P-P	0 / 0
O-P	0 / 0	Q-Q	0 / 0
P-Q	0 / 0	R-R	0 / 0
Q-R	0 / 0	S-S	0 / 0
R-S	0 / 0	T-T	0 / 0
S-T	0 / 0	U-U	0 / 0
T-U	0 / 0	V-V	0 / 0
U-V	0 / 0	W-W	0 / 0
V-W	0 / 0	X-X	0 / 0
W-X	0 / 0	Y-Y	0 / 0
X-Y	0 / 0	Z-Z	0 / 0
Y-Z	0 / 0		
Z	0 / 0		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.06")
CALCULATED VERT. DEFL. (LL) = L/999 (0.12")
ALLOWABLE DEFL. (TL) = L/360 (1.06")
CALCULATED VERT. DEFL. (TL) = L/699 (0.21")

CSI: TC=0.55/1.00 (G-H:1), BC=0.44/1.00 (K-M:1),
WB=0.53/1.00 (H-K:1), SS=0.24/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.88 (H) (INPUT = 0.90)
JSI METAL= 0.74 (P) (INPUT = 1.00)

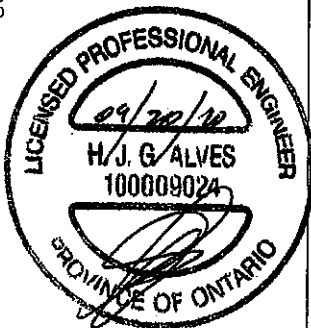

Structural component only
DWG# T-2006491

JOB NAME 408165	TRUSS NAME T25	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:44:22 2020 Page 1	
ID:1ebEM4Ce92xm94Zv?jkFPizmBR3-GBMoKB1Eyr_ODAEv?xILbRGRCjePyXzPH8K2SsqzP1Zn				31-11-0 33-2-8	
Scale = 1:53.3					

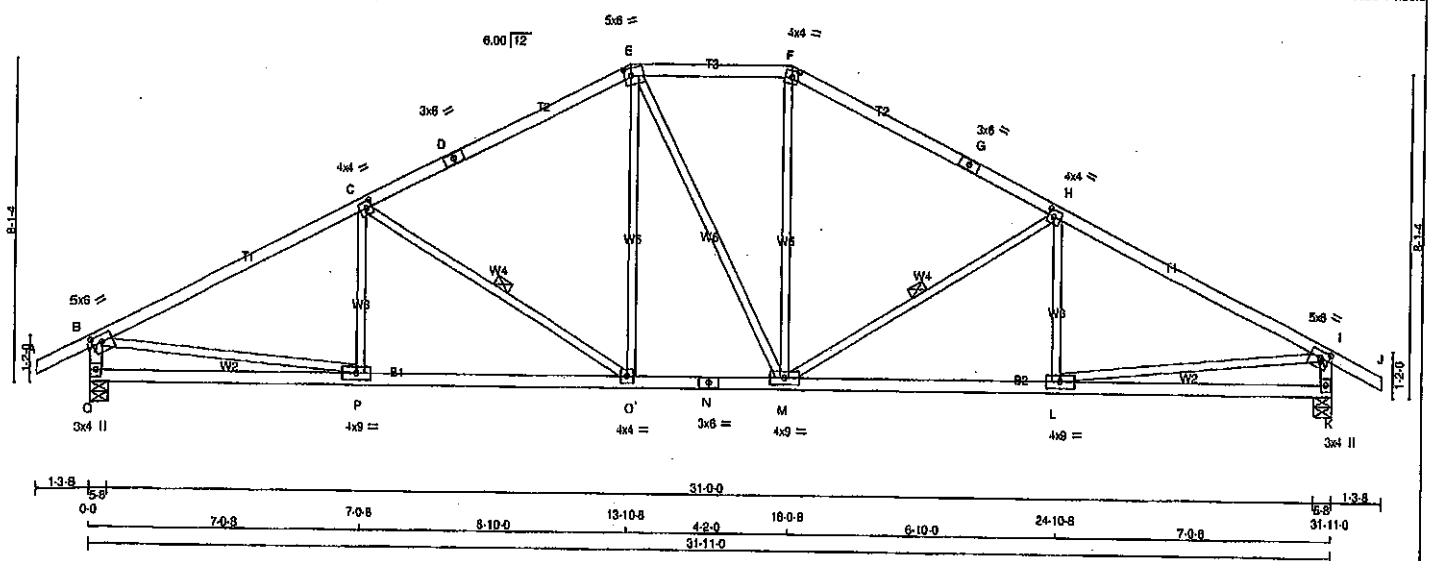

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - J	2x4	DRY	No.2
Q - B	2x4	DRY	No.2
K - I	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	X
B	TMVW-I	MT20	5.0	8.0	2.00 2.75
C	TMVW-I	MT20	4.0	4.0	2.00 1.75
D	TS-I	MT20	3.0	8.0	
E	TTWW-m	MT20	5.0	8.0	2.25 2.00
F	TTW-m	MT20	4.0	4.0	2.00 1.75
G	TS-I	MT20	3.0	8.0	
H	TMVW-I	MT20	4.0	4.0	2.00 1.75
I	TMVW-I	MT20	5.0	8.0	2.00 2.75
K	BMV-I-p	MT20	3.0	4.0	
L	BMVW-I	MT20	4.0	9.0	
M	BMVW-I	MT20	4.0	9.0	
N	BS-I	MT20	3.0	8.0	
O	BMVW-I	MT20	4.0	4.0	
P	BMVW-I	MT20	4.0	9.0	
Q	BMV-I-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	UP	BRG	BRG	IN-SX
Q	1884	0	0	1884	0	0	5-8	5-8	
K	1884	0	0	1884	0	0	5-8	5-8	

UNFACTORED REACTIONS		1ST CASE		MAX/MIN COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
Q	1330	886 / 0	0 / 0	0 / 0	0 / 0
K	1330	886 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-O, H-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO	FROM TO	FR-TO	FROM TO
A-B	0 / 28	P-C	-140 / 71
B-C	-2587 / 0	C-O	-661 / 0
C-D	-2013 / 0	O-E	0 / 458
D-E	-2013 / 0	E-M	0 / 2
E-F	-1775 / 0	M-F	0 / 480
F-G	-2013 / 0	F-H	-660 / 0
G-H	-2013 / 0	H-I	-142 / 70
H-I	-2587 / 0	I-J	0 / 2362
I-J	0 / 28	J-K	0 / 2361
Q-B	-1830 / 0		
K-I	-1830 / 0		
Q-P	0 / 0		
P-O	0 / 2344		
O-N	0 / 1774		
N-M	0 / 1774		
M-L	0 / 2344		
L-K	0 / 0		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
BOT CH. LL = 8.0 PSF
DL = 0.0 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 81.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.08")
CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
ALLOWABLE DEFL.(TL) = L/360 (1.08")
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.78/1.00 (B-C:1), BC=0.48/1.00 (O-P:1), WB=0.53/1.00 (B-P:1), SI=0.28/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


GRIP=0.89 (B) (INPUT = 0.90)
SI METAL=0.70 (B) (INPUT = 1.00)

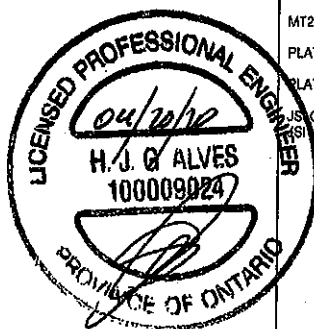

Structural component only
DWG# T-2006492

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408165	T26	8	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 08:44:23 2020 Page 1
 ID:1ebEM4C92xn94Zv7jkFPIzmBR3-kNwAXX1i16FfK06Ze8a7ecjN7_Bh_xZgn4b_GzPzIM
 1-3-8 0-0 5-5-8 5-5-8 5-9-0 10-4-8 5-3-0 15-11-8 5-3-0 21-2-8 25-5-8 5-5-8 31-11-0 33-2-8
 Scale = 1:53.5

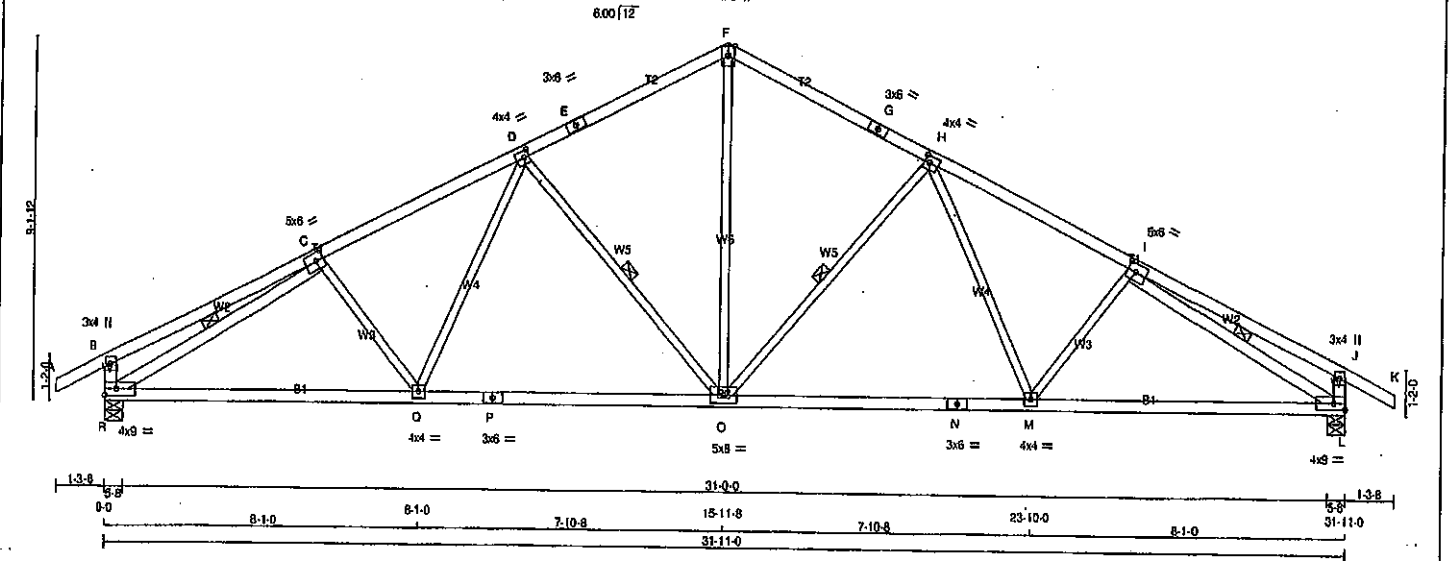

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - K	2x4	DRY	No.2
R - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
R - P	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
R - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMW+p	MT20	3.0	4.0
C	TMWW-I	MT20	5.0	8.0 2.60 2.50
D	TMWW-I	MT20	4.0	4.0 2.00 1.50
E	TS-I	MT20	3.0	8.0
F	TTW+p	MT20	4.0	6.0 Edge
G	TS-I	MT20	3.0	6.0
H	TMWW-I	MT20	4.0	4.0 2.00 1.50
I	TMWW-I	MT20	5.0	8.0 2.50 2.50
J	TMW+p	MT20	3.0	4.0
L	BMWW-I	MT20	4.0	9.0 Edge
M	BMWW-I	MT20	4.0	4.0
N	BS-I	MT20	3.0	8.0
O	BMWW-I	MT20	5.0	8.0
P	BS-I	MT20	3.0	6.0
Q	BMWW-I	MT20	4.0	4.0
R	BMWW-I	MT20	4.0	9.0 Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
<u>BEARINGS</u>							
	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
R	1884	0	1884	0	0	5-8	5-8
L	1884	0	1884	0	0	5-8	5-8
<u>UNFACTORED REACTIONS</u>							
	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1330	888 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0
L	1330	888 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, L							

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, L

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.11 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF H-O, D-O, C-R, I-L

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. FACTORED CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0/28	-91.8	-91.8 0.12 (1)	10.00	O-F	0/1211	0.27 (1)
B-C	0/20	-91.8	-91.8 0.33 (1)	10.00	O-H	-701/0	0.32 (1)
C-D	-2428/0	-91.8	-91.8 0.37 (1)	4.11	H-M	0/312	0.07 (1)
D-E	-1808/0	-91.8	-91.8 0.34 (1)	4.65	M-I	-158/21	0.05 (1)
E-F	-1808/0	-91.8	-91.8 0.34 (1)	4.65	D-O	-701/0	0.32 (1)
F-G	-1808/0	-91.8	-91.8 0.34 (1)	4.65	O-D	0/312	0.07 (1)
G-H	-1808/0	-91.8	-91.8 0.34 (1)	4.65	C-Q	-158/21	0.05 (1)
H-I	-2428/0	-91.8	-91.8 0.37 (1)	4.11	R-C	-2717/0	0.55 (1)
I-J	0/20	-91.8	-91.8 0.33 (1)	10.00	I-L	-2717/0	0.55 (1)
J-K	0/28	-91.8	-91.8 0.12 (1)	10.00			
R-B	-325/0	0.0	0.0 0.03 (1)	7.81			
L-J	-325/0	0.0	0.0 0.03 (1)	7.81			
R-Q	0/2288	-18.5	-18.5 0.51 (1)	10.00			
O-P	0/2051	-18.5	-18.5 0.48 (1)	10.00			
P-O	0/2051	-18.5	-18.5 0.48 (1)	10.00			
O-N	0/2051	-18.5	-18.5 0.48 (1)	10.00			
N-M	0/2051	-18.5	-18.5 0.48 (1)	10.00			
M-L	0/2288	-18.5	-18.5 0.51 (1)	10.00			

TOTAL WEIGHT = 8 X 133 = 1068 LB

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOY CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.06')
 CALCULATED VERT. DEFL. (LL) = L/999 (0.11')
 ALLOWABLE DEFL. (TL) = L/360 (1.06')
 CALCULATED VERT. DEFL. (TL) = L/999 (0.24')

CSI: TC=0.37/1.00 (H-I), BC=0.51/1.00 (L-M), WB=0.55/1.00 (I-L), SSI=0.20/1.00 (J-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

ISI GRIP = 0.85 (I) (INPUT = 0.90)
 ISI METAL = 0.67 (I) (INPUT = 1.00)

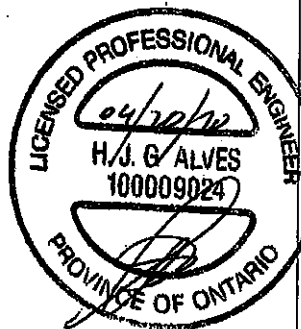

Structural component only
 DWG# T-2006493

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:55:33 2020 Page 1

ID:1sbEM4Ca92xn94Zv7kPFpizmBR3-wnkOI1?nE1vsuRx8BTBRBPSAJa98ZymWWHs1cUzMDcO

1-3-8 0-0 4-8-5 4-8-5 10-4-9 15-11-8 5-6-15 21-6-7 5-6-3 27-2-11 4-8-5 31-11-0 32-2-0

1-3-8 4-8-5 5-6-3 5-6-15 5-6-3 1-3-8

Scale = 1:52.6



BUILDING DESIGNER							
BEARINGS							
FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
JT	1886	0	1886	0	0	5-8	5-8
K	1886	0	1886	0	0	5-8	5-8

UNFACTORED REACTIONS							
1ST LCASE		MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1331	887 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0
K	1331	887 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S. K

BRACING									
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.42 FT.									
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.									
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.									
LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LOAD LC1 CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)		
FR-TO		FROM TO			FR-TO				
A-B	0 / 38	-91.8	-91.8	0.12 (1)	10.00	R-C	-286 / 0	0.10 (1)	
B-C	-1898 / 0	-91.8	-91.8	0.45 (1)	4.42	C-Q	0 / 1515	0.34 (1)	
C-D	-2854 / 0	-91.8	-91.8	0.51 (1)	3.65	Q-D	-868 / 0	0.32 (1)	
D-E	-3002 / 0	-91.8	-91.8	0.55 (1)	3.42	D-O	0 / 443	0.10 (1)	
E-F	-3002 / 0	-91.8	-91.8	0.55 (1)	3.42	O-E	-472 / 0	0.18 (1)	
F-G	-3002 / 0	-91.8	-91.8	0.55 (1)	3.42	O-G	0 / 443	0.10 (1)	
G-H	-2584 / 0	-91.8	-91.8	0.51 (1)	3.65	M-H	-889 / 0	0.32 (1)	
H-I	-1898 / 0	-91.8	-91.8	0.45 (1)	4.42	L-H	0 / 1515	0.34 (1)	
I-J	0 / 38	-91.8	-91.8	0.12 (1)	10.00	M-H	-286 / 0	0.10 (1)	
S-B	-1852 / 0	0.0	0.0	0.19 (1)	6.16	B-R	0 / 1552	0.35 (1)	
K-I	-1852 / 0	0.0	0.0	0.19 (1)	6.16	L-I	0 / 1552	0.35 (1)	
S-R	0 / 0	-18.5	-18.5	0.12 (4)	10.00				
R-Q	0 / 1500	-18.5	-18.5	0.31 (1)	10.00				
Q-P	0 / 2665	-18.5	-18.5	0.48 (1)	10.00				
P-O	0 / 2665	-18.5	-18.5	0.48 (1)	10.00				
O-N	0 / 2665	-18.5	-18.5	0.48 (1)	10.00				
N-M	0 / 2665	-18.5	-18.5	0.48 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.5	PSF
	DL	=	8.0	PSF
BOY CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 N.C.C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.5 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.06")
CALCULATED VERT. DEFL.(LL) = L/999 (0.15")
ALLOWABLE DEFL.(TL) = L/360 (1.06")
CALCULATED VERT. DEFL.(TL) = L/999 (0.28")

CSI: TC=0.85/1.00 (D-E:1), BC=0.48/1.00 (O-Q:1),
WB=0.35/1.00 (R-P:1), SSI=0.24/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GR5/DK50 SHEAR SECTION




Structural component only
DWG# T-2007733

JOB NAME:	TRUSS NAME:	QUANTITY:	PLY:	JOB DESC.:	DRWGNO.:
408164	T28	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 26 10:55:34 2020 Page 1
ID:1ebEM4Ce92xn94Zv7kFPizmBR3-O_u8ce2dYY9m3207kAigjd_KR_W9iu5gLBb8wzMDcN

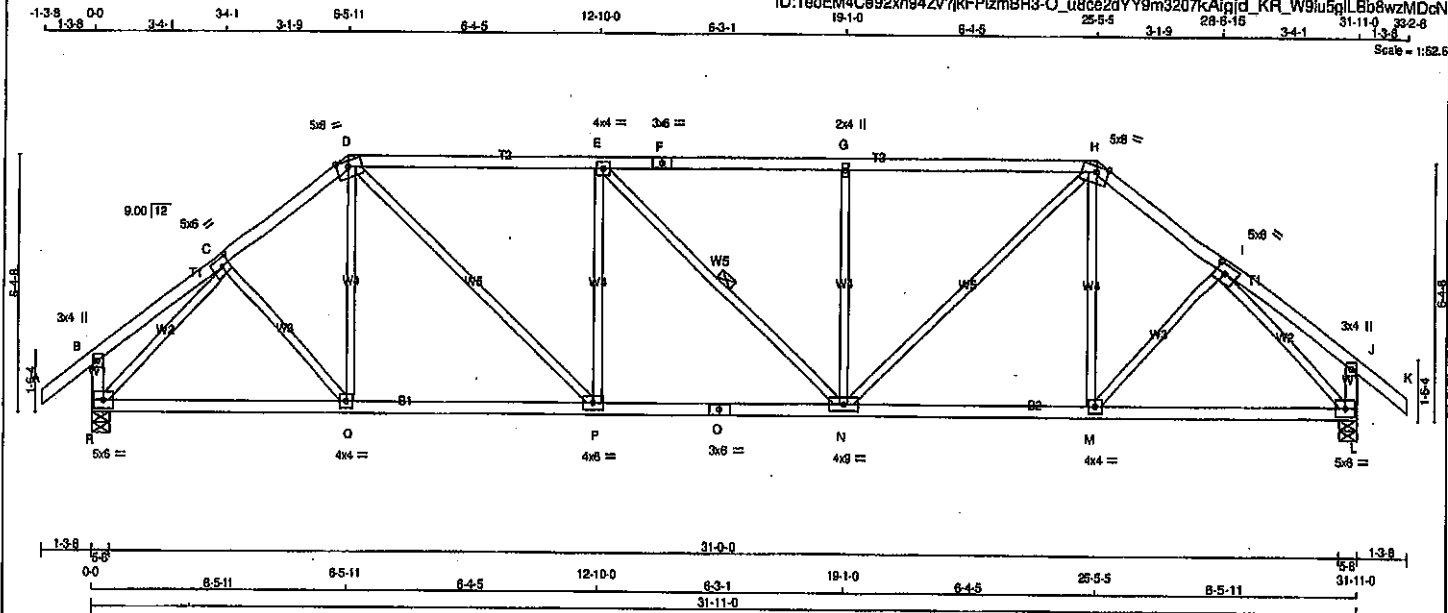

TOTAL WEIGHT = 2 X 137 = 274 lb

LUMBER				N. L. G. A. RULES	
CHORDS	SIZE	LUMBER	DESCR.	SPF	
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - K	2x4	DRY	No.2	SPF	
R - B	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
R - O	2x4	DRY	No.2	SPF	
O - L	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
DRY: SEASONED LUMBER.					

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
C	TMWW-t	MT20	5.0	8.0	2.50 2.75
D	TTWW-m	MT20	5.0	8.0	Edge 3.50
E	TMWW-t	MT20	4.0	4.0	
F	TS-t	MT20	3.0	8.0	
G	TMW-w	MT20	2.0	4.0	
H	TTWW-m	MT20	5.0	8.0	Edge 3.50
I	TMWW-t	MT20	5.0	8.0	2.50 2.75
J	TMV+p	MT20	3.0	4.0	
L	BMVW-t	MT20	5.0	6.0	
M	BMWW-t	MT20	4.0	4.0	
N	BMWW-t	MT20	4.0	9.0	
O	BS-t	MT20	3.0	8.0	
P	BMWW-t	MT20	4.0	8.0	
Q	BMWW-t	MT20	4.0	4.0	
R	BMVW-t	MT20	5.0	8.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORIZ	BRG	UPLIFT	IN-SX	IN-SX
R	1888	0	1888	0	0	5-8	5-8	5-8	5-8
L	1888	0	1888	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST LOASE		MAX/MIN COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM	LIVE	WIND	DEAD	SOIL	
R	1331	887 / 0	0 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0	
L	1331	887 / 0	0 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.78 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO				FR-TO			
A-B	0 / 38	-91.8	-91.8 0.12 (1)	C-Q	0 / 131	0.03 (4)	
B-C	0 / 18	-91.8	-91.8 0.13 (1)	Q-D	0 / 88	0.03 (4)	
C-D	-1910 / 0	-91.8	-91.8 0.18 (1)	D-P	0 / 1071	0.24 (1)	
D-E	-2288 / 0	-91.8	-91.8 0.89 (1)	P-E	-827 / 0	0.41 (1)	
E-F	-2284 / 0	-91.8	-91.8 0.88 (1)	E-N	-2 / 0	0.00 (1)	
F-G	-2284 / 0	-91.8	-91.8 0.88 (1)	N-G	-827 / 0	0.41 (1)	
G-H	-2284 / 0	-91.8	-91.8 0.88 (1)	H-N	0 / 1089	0.24 (1)	
H-I	-1910 / 0	-91.8	-91.8 0.18 (1)	M-H	0 / 88	0.03 (4)	
I-J	0 / 18	-91.8	-91.8 0.13 (1)	M-I	0 / 131	0.03 (4)	
J-K	0 / 38	-91.8	-91.8 0.12 (1)	R-C	-2134 / 0	0.79 (1)	
R-B	-245 / 0	0.0	0.0 0.03 (1)	I-L	-2134 / 0	0.79 (1)	
L-J	-245 / 0	0.0	0.0 0.03 (1)				

R-Q	0 / 1420	-18.5	-18.5 0.33 (1)	10.00
Q-P	0 / 1510	-18.5	-18.5 0.35 (1)	10.00
P-O	0 / 2288	-18.5	-18.5 0.43 (1)	10.00
O-N	0 / 2288	-18.5	-18.5 0.43 (1)	10.00
N-M	0 / 1511	-18.5	-18.5 0.35 (1)	10.00
M-L	0 / 1421	-18.5	-18.5 0.33 (1)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.8	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- THO 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.08")
CALCULATED VERT. DEFL.(LL) = $L/899$ (0.10")
ALLOWABLE DEFL.(TL) = $L/360$ (1.08")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.21")

CSI: TC=0.69/1.00 (D-E:1), BC=0.43/1.00 (N-P:1), WB=0.79/1.00 (L:1), SS=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.87 (L) (INPUT = 0.90)
JSI METAL= 0.78 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007734

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408164	T29	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Tue Apr 28 10:55:35 2020 Page 1
 ID:1ebEM4Ca92xn94Zv7JkFPlzmBR3-JASWp_2FJrHdhBbJluDvGqXT4OXRJnp_7x8gNzMDcm
 31-11-0 33-2-8 1-3-8
 Scale = 1:52.6

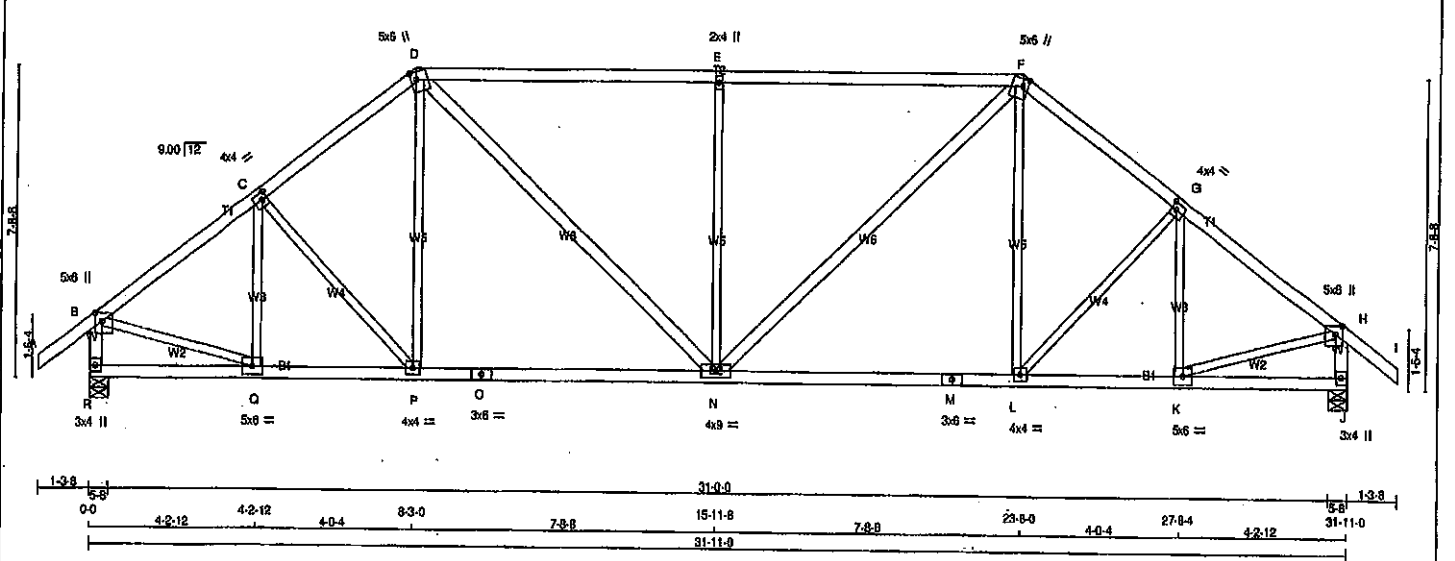

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - B	2x4	DRY	No.2
B - H	2x4	DRY	No.2
H - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+P	MT20	5.0	8.0	2.50 2.00
C	TMVW+I	MT20	4.0	4.0	2.00 1.50
D	TMVW+m	MT20	5.0	8.0	2.25 1.50
E	TMVW+w	MT20	2.0	4.0	
F	TMVW+m	MT20	5.0	8.0	2.25 1.50
G	TMVW+I	MT20	4.0	4.0	2.00 1.50
H	TMVW+P	MT20	5.0	8.0	2.50 2.00
J	BMV1+P	MT20	3.0	4.0	
K	BMVW+I	MT20	5.0	8.0	
L	BMVW+I	MT20	4.0	4.0	
M	BS+I	MT20	3.0	6.0	
N	BMVW+I	MT20	4.0	4.0	
O	BS+I	MT20	3.0	6.0	
P	BMVW+I	MT20	4.0	4.0	
Q	BMVW+I	MT20	5.0	8.0	
R	BMV1+P	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	BRG	UPLIFT	BRG	IN-SX
R	1886	0	1886	0	0	5-8	5-8	5-8	5-8
J	1886	0	1886	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST CASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	1331	887/0	0/0	0/0	0/0	444/0	0/0
J	1331	887/0	0/0	0/0	0/0	444/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.61 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO	0/38			FR-TO			
A-B	0/38	-91.8	-91.8 0.12 (1)	Q-C	-384/0	0.12 (1)	
B-C	-1877/0	-91.8	-91.8 0.24 (1)	G-P	-87/0	0.05 (1)	
C-D	-1858/0	-91.8	-91.8 0.24 (1)	P-D	0/182	0.05 (4)	
D-E	-1985/0	-91.8	-91.8 0.32 (1)	D-N	0/736	0.12 (1)	
E-F	-1985/0	-91.8	-91.8 0.32 (1)	N-E	-871/0	0.06 (1)	
F-G	-1858/0	-91.8	-91.8 0.24 (1)	N-F	0/736	0.12 (1)	
G-H	-1877/0	-91.8	-91.8 0.24 (1)	L-F	0/182	0.05 (4)	
H-I	0/38	-91.8	-91.8 0.12 (1)	L-G	-87/0	0.06 (1)	
R-B	-1849/0	0.0	0.0 0.19 (1)	K-G	-364/0	0.12 (1)	
J-H	-1849/0	0.0	0.0 0.19 (1)	B-Q	0/1581	0.36 (1)	
				K-H	0/1581	0.36 (1)	
R-Q	0/0	-18.5	-18.5 0.08 (4)				
Q-P	0/1522	-18.5	-18.5 0.33 (1)				
P-O	0/1465	-18.5	-18.5 0.36 (1)				
O-N	0/1465	-18.5	-18.5 0.36 (1)				
N-M	0/1465	-18.5	-18.5 0.36 (1)				
M-L	0/1465	-18.5	-18.5 0.36 (1)				
L-K	0/1522	-18.5	-18.5 0.33 (1)				
K-J	0/0	-18.5	-18.5 0.08 (4)				

TOTAL WEIGHT = 2 X 147 = 295 lb [M/F]

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF NBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.08")
 CALCULATED VERT. DEFL. (LL) = L/999 (0.08")
 ALLOWABLE DEFL. (TL) = L/360 (1.08")
 CALCULATED VERT. DEFL. (TL) = L/989 (0.17")

CSI: TC=0.82/1.00 (D-E:1), BC=0.38/1.00 (N-P:1), WB=0.98/1.00 (E-N:1), SS=0.34/1.00 (D-E:1)

DOE LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (B) (INPUT = 0.90)
 JSI METAL= 0.46 (C) (INPUT = 1.00)



Structural component only
 DWG# T-2007735

Tamarack Roof Truss, Burlington



DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.8	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018 , OBC 2012 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.46/1.00 (E-F:1), BC=0.31/1.00 (P-Q:1),
WB=0.36/1.00 (B-Q:1), SSI=0.26/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY) (PSI)		SHEAR (PL)		SECTION (PL)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	818	354	1667	788	1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg

JSI GRIP= 0.89 (B) (INPUT = 0.90)
JSI METAL= 0.45 (O) (INPUT = 1.00)



JOB NAME 408164	TRUSS NAME T31	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

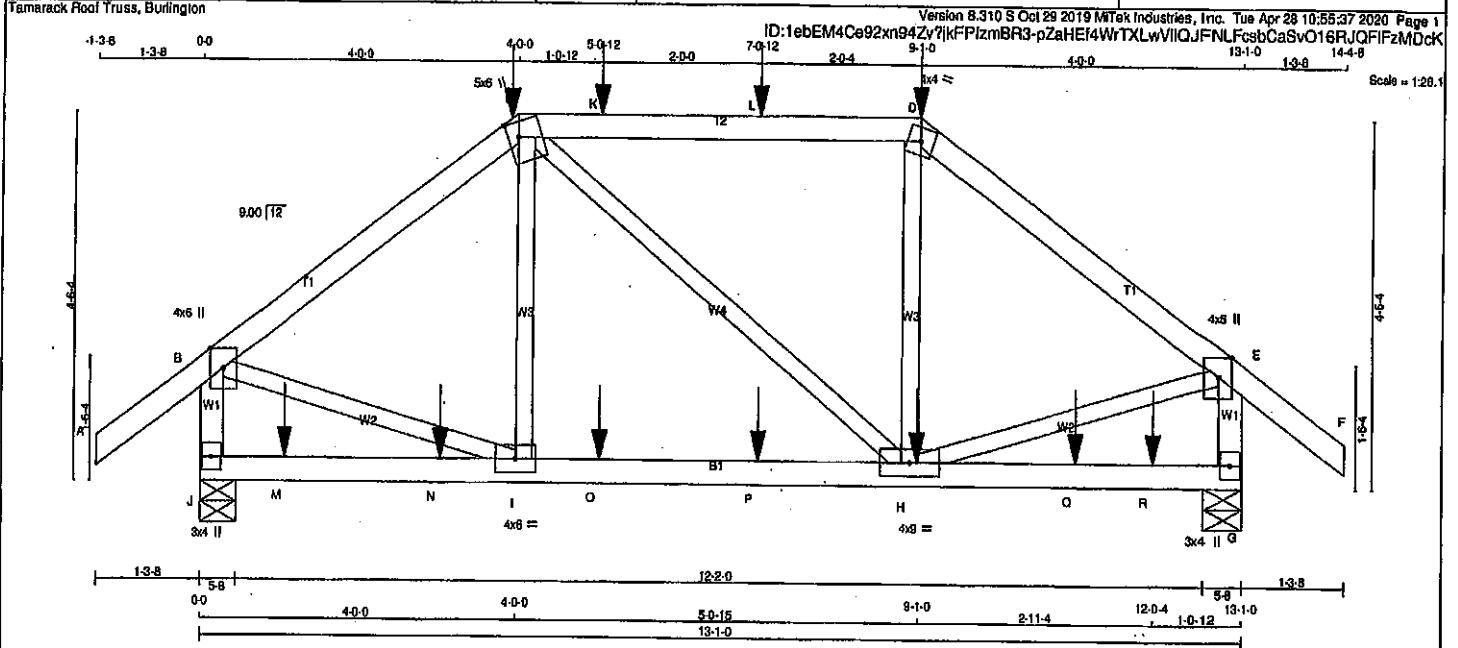

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - G	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
J - B	2x4	DRY	No.2
G - E	2x4	DRY	No.2
J - G	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMVW+P	MT20	4.0	8.0	Edge
C TTWW+m	MT20	5.0	8.0	2.25 1.50
D TTW-m	MT20	4.0	4.0	
E TMVW+P	MT20	4.0	8.0	Edge
G BMV1+P	MT20	3.0	4.0	
H BMWW-1	MT20	4.0	8.0	
I BMWW-1	MT20	4.0	6.0	
J BMV1+P	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE, TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG
J	1153	0	1153	0	0	0	5-8	5-8	5-8
G	1177	0	1177	0	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST CASE		MAX./MIN. COMPONENT REACTIONS		COMBINED		SNOW		LIVE		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	VERT	HORZ	VERT	HORZ	VERT	HORZ	VERT	HORZ	VERT	HORZ	VERT	HORZ	VERT	HORZ	VERT	HORZ	VERT	HORZ
J	813	547 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	268 / 0	0 / 0	0 / 0	0 / 0
G	831	558 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	275 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, G

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.63 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 (LC)	MAX. (PLF)	LC1 (LC)	MEMB.	FORCE (LBS)	MAX. (PLF)	LC1 (LC)
FR-TO		FROM	TO			FR-TO		FROM	TO
A-B	0 / 38	-91.8	-91.8 0.14 (1)	10.00		I-C	-89 / 84	0.03 (1)	
B-C	-982 / 0	-91.8	-91.8 0.30 (1)	5.91	C-H	0 / 25	0.01 (1)		
C-K	-785 / 0	-91.8	-91.8 0.63 (1)	5.63	H-D	-117 / 81	0.04 (1)		
K-L	-785 / 0	-91.8	-91.8 0.63 (1)	5.63	B-I	0 / 800	0.20 (1)		
L-D	-785 / 0	-91.8	-91.8 0.63 (1)	5.63	H-E	0 / 820	0.20 (1)		
D-E	-987 / 0	-91.8	-91.8 0.30 (1)	5.63					
E-F	0 / 38	-91.8	-91.8 0.14 (1)	10.00					
J-B	-1113 / 0	0.0	0.0 0.13 (1)	7.48					
G-E	-1133 / 0	0.0	0.0 0.13 (1)	7.43					
J-M	0 / 0	-18.5	-18.5 0.13 (4)	10.00					
M-N	0 / 0	-18.5	-18.5 0.13 (4)	10.00					
N-I	0 / 0	-18.5	-18.5 0.13 (4)	10.00					
I-O	0 / 788	-18.5	-18.5 0.20 (1)	10.00					
O-P	0 / 788	-18.5	-18.5 0.20 (1)	10.00					
P-H	0 / 788	-18.5	-18.5 0.20 (1)	10.00					
H-Q	0 / 0	-18.5	-18.5 0.13 (4)	10.00					
Q-R	0 / 0	-18.5	-18.5 0.13 (4)	10.00					
R-G	0 / 0	-18.5	-18.5 0.13 (4)	10.00					

FACTORED CONCENTRATED LOADS (LBS)		MAX. FACTORED		FACE		DIR.		TYPE		HEEL		CONN.	
JT	LOC.	LC1	MAX.	MAX.									
C	4-0-0	-31	-35		FRONT	VERT.	DEAD					C1	
C	4-0-0	-135	-135		FRONT	VERT.	SNOW					C1	
D	9-1-0	-31	-35		FRONT	VERT.	DEAD					C1	
D	9-1-0	-74	-74		BACK	VERT.	TOTAL					C1	
D	9-1-0	-135	-135		FRONT	VERT.	SNOW					C1	
H	9-0-12	-13	-13		BACK	VERT.	TOTAL					C1	
K	5-0-12	-87	-87		BACK	VERT.	TOTAL					C1	
L	7-0-12	-87	-87		BACK	VERT.	TOTAL					C1	
M	1-0-12	-13	-13		BACK	VERT.	TOTAL					C1	
N	3-0-12	-13	-13		BACK	VERT.	TOTAL					C1	
O	5-0-12	-13	-13		BACK	VERT.	TOTAL					C1	
P	7-0-12	-13	-13		BACK	VERT.	TOTAL					C1	
Q	11-0-12	-13	-13		BACK	VERT.	TOTAL					C1	
R	12-0-4	-13	-13		BACK	VERT.	TOTAL					C1	

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 56 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.44")
CALCULATED VERT. DEFL. (LL) = L/989 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.44")
CALCULATED VERT. DEFL. (TL) = L/989 (0.03")

CSI: TC=0.83/1.00 (C-D:1), BC=0.20/1.00 (H-I:1),
WB=0.20/1.00 (E-H:1), SSI=0.27/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR. SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 610 354 1687 788 1987 1650

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.83 (E) (INPUT = 0.90)
JSI METAL = 0.52 (E) (INPUT = 1.00)



Structural component only
DWG# T-2007737

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408164	T32	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MATEK Industries, Inc. Tue Apr 28 10:55:35 2020 Page 1	

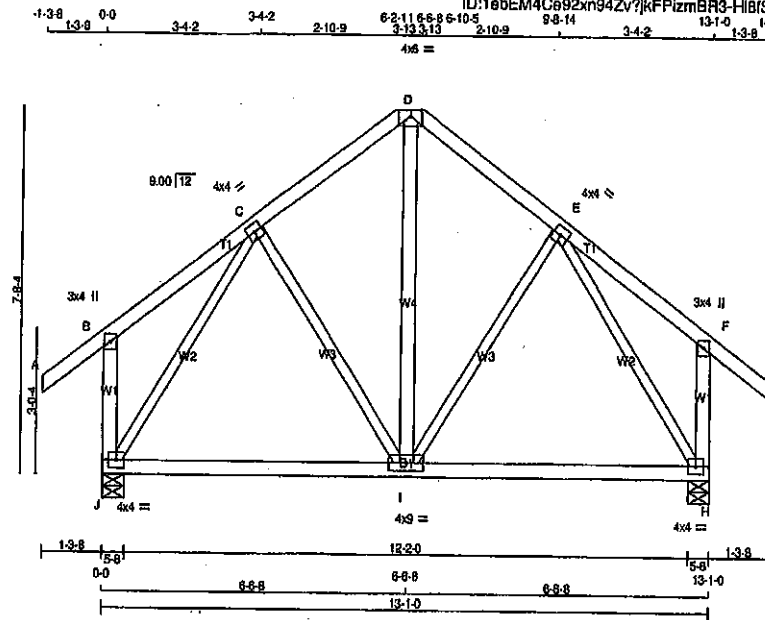

Scale = 1/48

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
J - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
I - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
C	TMVW+4	MT20	4.0	4.0
D	TMVW+m	MT20	4.0	6.0 Edge
E	TMVW+4	MT20	4.0	4.0
F	TMV+p	MT20	3.0	4.0
H	BMVW+4	MT20	4.0	4.0
I	BMVW+4	MT20	4.0	9.0
J	BMVW+4	MT20	4.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UPLIFT
J	848	0	848	0
H	848	0	848	0

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN.	COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
J	597	405/0	0/0	0/0	0/0	192/0	0/0	
H	597	405/0	0/0	0/0	0/0	192/0	0/0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED		MEMB.	MAX. FACTORED		
	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)		FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0/38	-91.8	-91.8 0.12 (1)	I-D	0/253	0.04 (1)	
B-C	0/21	-91.8	-91.8 0.16 (1)	C-I	-81/19	0.04 (1)	
C-D	-424/0	-91.8	-91.8 0.12 (1)	I-E	-81/19	0.04 (1)	
D-E	-424/0	-91.8	-91.8 0.12 (1)	J-C	-693/0	0.41 (1)	
E-F	0/21	-91.8	-91.8 0.16 (1)	E-H	-693/0	0.41 (1)	
F-G	0/38	-91.8	-91.8 0.12 (1)				
J-B	-242/0	0.0	0.0 0.04 (1)				
H-F	-242/0	0.0	0.0 0.04 (1)				
J-I	0/356	-18.5	-18.5 0.26 (4)				
I-H	0/356	-18.5	-18.5 0.26 (4)				

TOTAL WEIGHT = 70 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.44")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.44")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TO=0.18/1.00 (E-F:1), BC=0.26/1.00 (H-I:4), WB=0.41/1.00 (C-J:1), SS=0.12/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1687

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.77 (C) (INPUT = 0.90)
JSI METAL= 0.23 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007738

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408165	T33S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Fri Apr 17 08:44:25 2020 Page 1

ID:Ovhtky48CQcPQc_Y353NoTWZlcKo-hm2wyD37EMM24eyUg3D2D3u2Dxgu8ubs85Zi39zPiZK

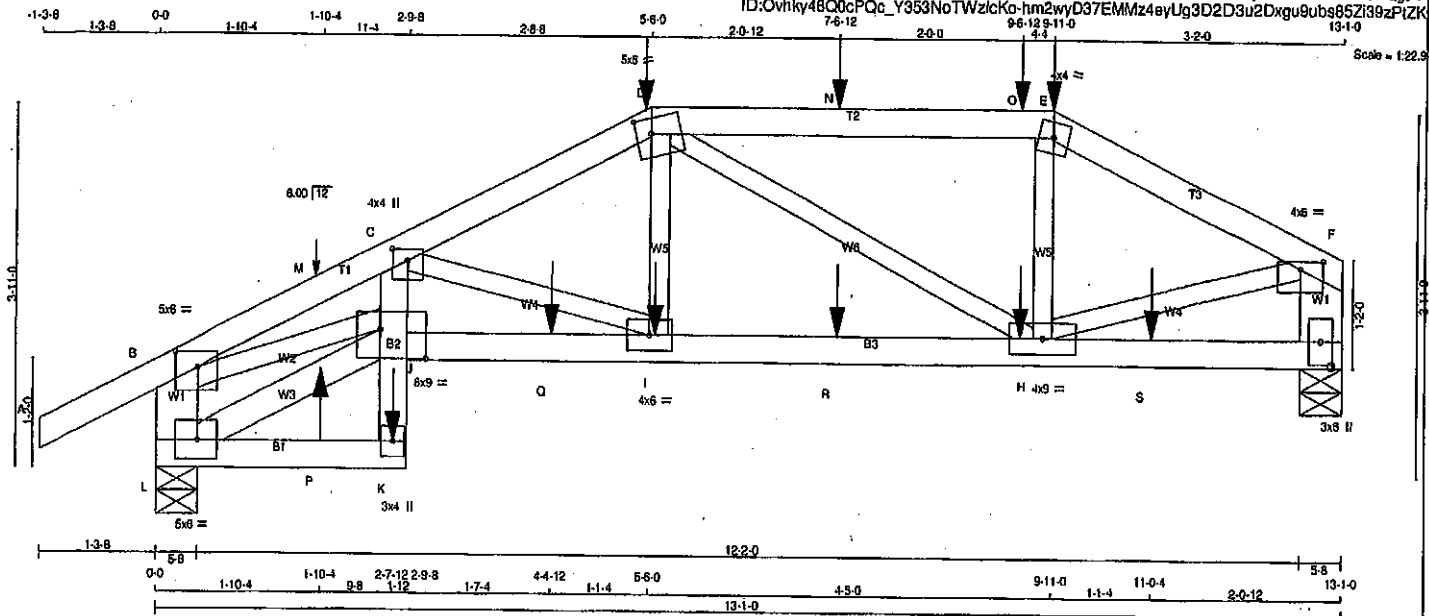

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
L - B	2x6	DRY	No.2
G - F	2x6	DRY	No.2
L - K	2x4	DRY	No.2
K - C	2x4	DRY	No.2
J - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
L - J	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y
B	TMVW-p	MT20	5.0	6.0
C	TMVW-p	MT20	4.0	4.0
D	TTWV-m	MT20	5.0	6.0
E	TTW-m	MT20	4.0	4.0
F	TMVW-p	MT20	4.0	6.0
G	BMV1-p	MT20	3.0	6.0
H	BMVWW-1	MT20	4.0	6.0
I	BMVWW-1	MT20	4.0	6.0
J	BMVWW-1	MT20	6.0	9.0
K	BMV-p	MT20	3.0	4.0
L	BMVW-1	MT20	5.0	6.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UPLIFT	IN-SX
G	1008	0	1008	0
L	1158	0	1158	0

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
G	711	480 / 0	0 / 0	0 / 0	0 / 0	231 / 0	0 / 0
L	814	560 / 0	0 / 0	0 / 0	0 / 0	254 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.21 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (7)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 28	-91.8	-91.8 0.13 (1)	10.00	C-I	-939 / 0	0.20 (1)
B-M	-2420 / 0	-91.8	-91.8 0.21 (1)	4.21	I-D	0 / 398	0.10 (1)
M-C	-2420 / 0	-91.8	-91.8 0.21 (1)	4.21	D-H	-389 / 0	0.18 (1)
C-D	-1595 / 0	-91.8	-91.8 0.18 (1)	5.02	H-E	0 / 77	0.03 (4)
D-N	-1108 / 0	-91.8	-91.8 0.41 (1)	5.41	H-F	0 / 1141	0.28 (1)
N-O	-1108 / 0	-91.8	-91.8 0.41 (1)	5.41	L-J	-143 / 0	0.02 (1)
O-E	-1108 / 0	-91.8	-91.8 0.41 (1)	5.41	B-J	0 / 2178	0.64 (1)
E-F	-1238 / 0	-91.8	-91.8 0.20 (1)	5.51			
L-B	-1077 / 0	0.0	0.0 0.08 (1)	7.81			
G-F	-982 / 0	0.0	0.0 0.07 (1)	7.81			
L-P	0 / 131	-18.5	-18.5 0.05 (4)	10.00			
P-K	0 / 131	-18.5	-18.5 0.05 (4)	10.00			
K-J	0 / 203	0.0	0.0 0.27 (1)	10.00			
J-C	0 / 422	0.0	0.0 0.30 (1)	10.00			
J-Q	0 / 2314	-18.5	-18.5 0.43 (1)	10.00			
Q-I	0 / 2314	-18.5	-18.5 0.43 (1)	10.00			
I-R	0 / 1442	-18.5	-18.5 0.30 (1)	10.00			
R-H	0 / 1442	-18.5	-18.5 0.30 (1)	10.00			
H-S	0 / 0	-18.5	-18.5 0.07 (4)	10.00			
S-G	0 / 0	-18.5	-18.5 0.07 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LOC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
D	5-6-0	-178	-178	---	FRONT	VERT	TOTAL	---	C1
E	9-11-0	-154	-154	---	FRONT	VERT	TOTAL	---	C1
H	9-6-12	-7	-7	---	FRONT	VERT	TOTAL	---	C1
I	5-6-12	-7	-7	---	FRONT	VERT	TOTAL	---	C1
K	2-7-12	-184	-184	---	FRONT	VERT	TOTAL	---	C1
M	1-10-4	1	1	104	FRONT	VERT	TOTAL	---	C1
N	7-6-12	-17	-17	---	FRONT	VERT	TOTAL	---	C1
O	9-6-12	-47	-47	---	FRONT	VERT	TOTAL	---	C1
P	1-10-4	7	7	12	FRONT	VERT	TOTAL	---	C1
Q	4-4-12	-3	-3	---	FRONT	VERT	TOTAL	---	C1
R	7-6-12	-7	-7	---	FRONT	VERT	TOTAL	---	C1
S	11-0-4	-3	-3	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.44")
CALCULATED VERT. DEFL.(LL) = L/899 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.44")
CALCULATED VERT. DEFL.(TL) = L/999 (0.10")

CSI: TC=0.41/1.00 (D-E:1), BC=0.43/1.00 (I-J:1), WB=0.54/1.00 (B-J:1), SS=0.22/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	618	354	1867

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (J) (INPUT = 0.90)
JSI METAL= 0.49 (B) (INPUT = 1.00)


Structural component only
DWG# T-2006495

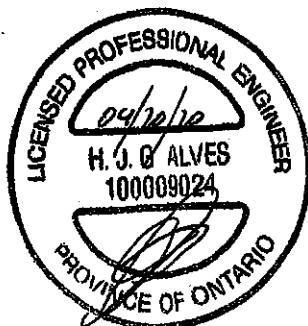

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408165	T34	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 28 2019 Mtek Industries, Inc. Fri Apr 17 08:44:28 2020 Page 1
ID:Ovhlky48Q0cPQc_Y353NoTWzlcKo-9ycI9Z4I?gUqInXgEnkHlHQD_K29u06?MlIFbzPlZU

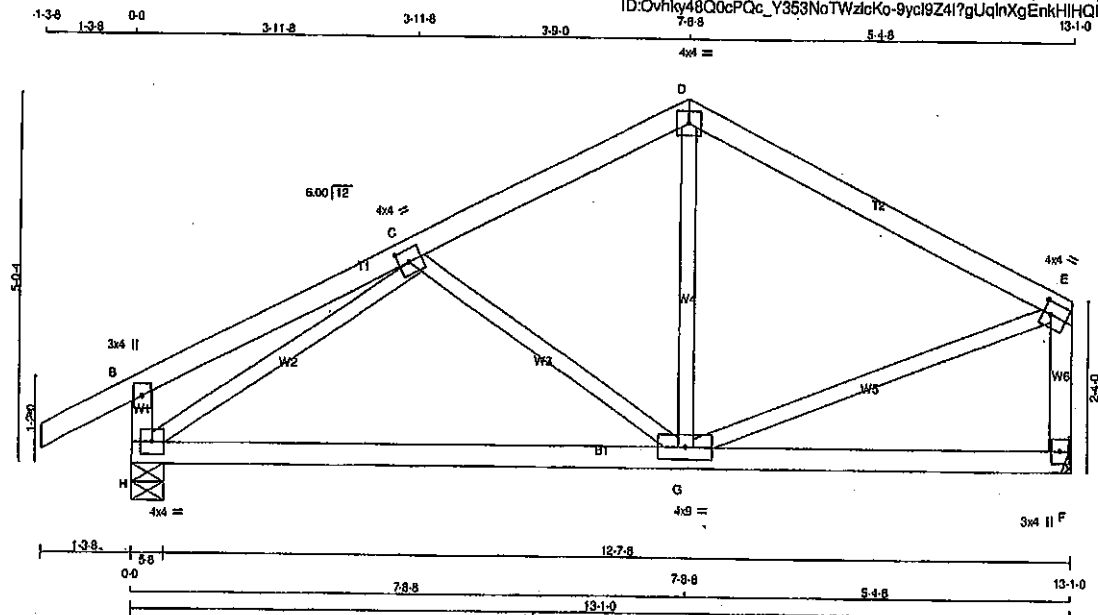

TOTAL WEIGHT = 4 X 52 = 207 lb
[M/F]

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
H - B	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (tablets in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV-p	MT20	3.0	4.0		
C	TMWW-I	MT20	4.0	4.0	2.00	1.75
D	TMV-p	MT20	4.0	4.0		
E	TMWW-I	MT20	4.0	4.0	2.00	1.25
F	BMV-I-p	MT20	3.0	4.0		
G	BMWW-I	MT20	4.0	4.0		
H	BMV-I-I	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UPLIFT
F	721	0	721	0
H	846	0	846	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1.8.

UNFACTORED REACTIONS
1ST CASE MAX./MIN. COMPONENT REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	510	335 / 0	0 / 0	0 / 0	0 / 0	175 / 0	0 / 0
H	596	404 / 0	0 / 0	0 / 0	0 / 0	192 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD	LC1	MAX	MAX.	MEMB.	FORCE	MAX.
FR-TO	(LBS)	FROM	TO	CSI (LC)	UNBRACED LENGTH	FR-TO	(LBS)	CSI (LC)
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	C-G	-275 / 0	0.10 (1)
B-C	0 / 18	-91.8	-91.8	0.21 (1)	10.00	G-D	0 / 124	0.04 (1)
C-D	-584 / 0	-91.8	-91.8	0.17 (1)	6.25	H-C	-898 / 0	0.33 (1)
D-E	-568 / 0	-91.8	-91.8	0.34 (1)	6.25	G-E	0 / 541	0.12 (1)
H-B	-262 / 0	0.0	0.0	0.03 (1)	7.81			
F-E	-690 / 0	0.0	0.0	0.09 (1)	7.81			
H-G	0 / 728	-18.5	-18.5	0.30 (4)	10.00			
G-F	0 / 0	-18.5	-18.5	0.25 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.44")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.44")
CALCULATED VERT. DEFL.(TL) = L/999 (0.10")

CSI: TC=0.34/1.00 (D-E:1), BC=0.30/1.00 (G-H:4),
WB=0.33/1.00 (C-H:1), SS=0.17/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.260 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.86 (E) (INPUT = 0.80)
JSI METAL = 0.28 (C) (INPUT = 1.00)

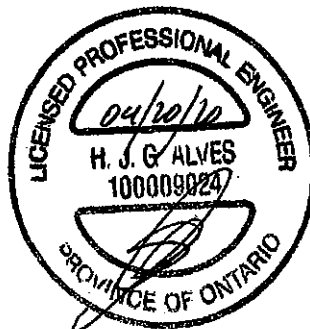

Structural component only
DWG# T-2006496

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Fri Apr 17 08:44:27 2020 Page 1

ID:0vhky48Q0cPQc_Y353NoTWzckKc-d8AHNu4NmzchJx8toUFWUzCkK0OdM8bP2p71zPzI/

13-8 13-8 0-0 3-11-8 3-11-8 3-8-8 3-8-8 13-1-0




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408164	T300	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:55:39 2020 Page 1

ID:1ebEM4Ce92xn94Zv?jKFPizmBR3-lx1fL5mM4n3Apv4XkHrCgICR78hNAmPvdvMp8zMDcl

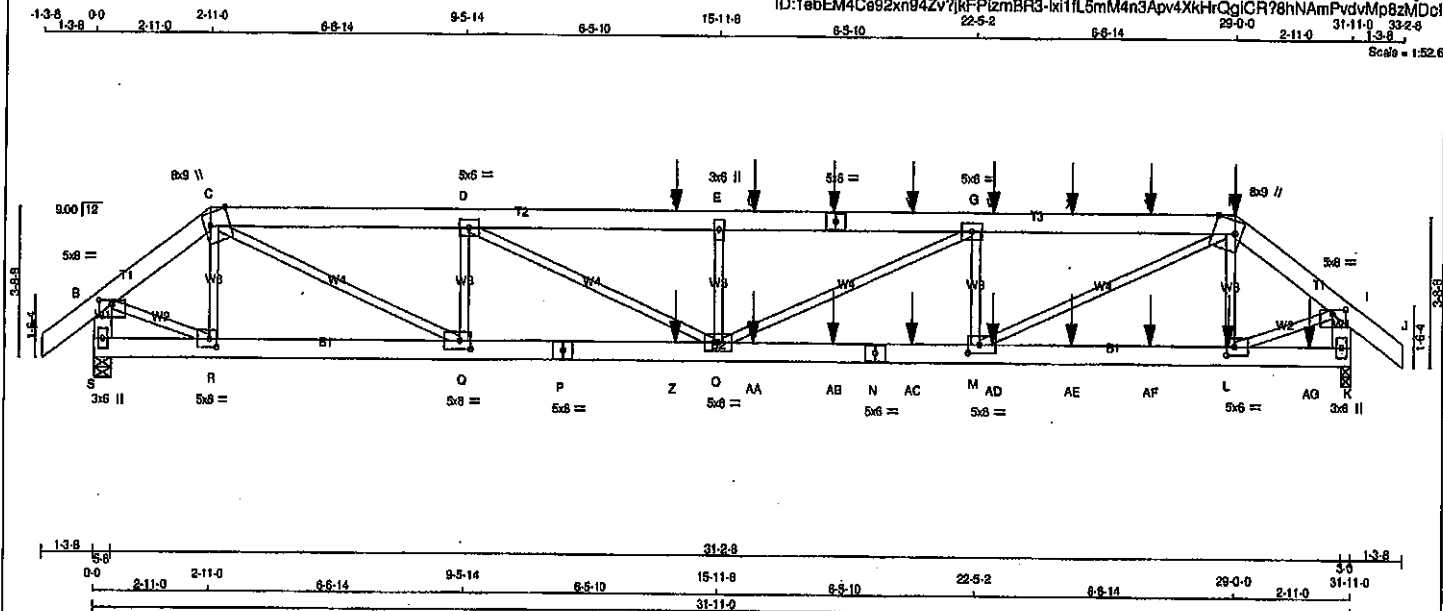

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
A - C	2x8	DRY	No.2
C - F	2x8	DRY	No.2
F - H	2x8	DRY	No.2
H - J	2x8	DRY	No.2
J - L	2x8	DRY	No.2
L - N	2x8	DRY	No.2
N - K	2x8	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)	PLATES	W	LEN	Y	X
JT TYPE	MT20	5.0	8.0	1.25	4.00
B TMVW-p	MT20	5.0	8.0	Edge 6.25	
C TTWW-m	MT20	5.0	8.0		
D TMVW-l	MT20	5.0	8.0		
E TMVW-w	MT20	5.0	8.0		
F TS-l	MT20	5.0	8.0		
G TMVW-l	MT20	5.0	8.0		
H TTWW-m	MT20	5.0	8.0	Edge 6.25	
I TMVW-p	MT20	5.0	8.0	1.25	4.00
K BMV-l-p	MT20	5.0	8.0		
L BMVW-l	MT20	5.0	8.0	2.50	2.25
M BMVW-l	MT20	5.0	8.0	2.50	3.25
N BS-l	MT20	5.0	8.0		
O BMVW-l	MT20	5.0	8.0		
P BS-l	MT20	5.0	8.0		
Q BMVW-l	MT20	5.0	8.0	2.50	3.25
R BMVW-l	MT20	5.0	8.0	2.60	2.25
S BMV-l-p	MT20	5.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
VERT	HORZ	DOWN	UPLIFT
IN-SX	IN-SX	IN-SX	IN-SX
JT	2105	0	5-8
S	2458	0	3-0
K	2458	0	3-0

UNFACTORED REACTIONS			
1ST CASE	MAX/MIN	COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE
S	1488	980 / 0	0 / 0
K	1734	1153 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.22 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. UNBRACED LENGTH (LBS)	MEMB.	FORCE (LBS)	MAX. UNBRACED LENGTH (LBS)	MAX. UNBRACED LENGTH (LBS)
FR-TO		FROM TO		FR-TO			
A-B	0 / 39	-91.8 -91.8 0.07 (1)	10.00	R-C	-412 / 0	0.09 (1)	
B-C	-2129 / 0	-91.8 -91.8 0.10 (1)	5.48	C-D	0 / 2844	0.73 (1)	
C-D	-4328 / 0	-91.8 -91.8 0.42 (1)	3.80	Q-Q	-1203 / 0	0.25 (1)	
D-E	-5422 / 0	-91.8 -91.8 0.50 (1)	3.37	D-O	0 / 1227	0.30 (1)	
E-F	-5422 / 0	-91.8 -91.8 0.50 (1)	3.37	C-E	-717 / 0	0.16 (1)	
F-G	-5422 / 0	-91.8 -91.8 0.81 (1)	3.22	O-O	0 / 730	0.18 (1)	
G-H	-5422 / 0	-91.8 -91.8 0.81 (1)	3.22	M-G	-1225 / 0	0.28 (1)	
H-I	-5422 / 0	-91.8 -91.8 0.81 (1)	3.22	M-H	0 / 3087	0.78 (1)	
I-J	-5422 / 0	-91.8 -91.8 0.81 (1)	3.22	L-H	-477 / 0	0.10 (1)	
J-K	-5422 / 0	-91.8 -91.8 0.81 (1)	3.48	B-R	0 / 1786	0.44 (1)	
K-L	-5422 / 0	-91.8 -91.8 0.81 (1)	3.48	L-I	0 / 2122	0.53 (1)	
X-Y	-4789 / 0	-91.8 -91.8 0.55 (1)	3.48				
Y-H	-4789 / 0	-91.8 -91.8 0.55 (1)	3.48				
H-I	-2528 / 0	-91.8 -91.8 0.11 (1)	3.48				
I-J	0 / 39	-91.8 -91.8 0.07 (1)	10.00				
S-B	-2117 / 0	0.0 0.0 0.15 (1)	6.95				
K-L	-2465 / 0	0.0 0.0 0.18 (1)	6.55				

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408164	T300	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:55:39 2020 Page 2
ID:1ebEM4Ce92xn94Zv7kfPzmbR3-k11L5mM4n3Apv4XkHrQaICR78hNAmPvdvMp8zMDcl


FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
U	18-10-4	-87	-87	---	FRONT	VERT	TOTAL	---	C1
V	20-10-4	-87	-87	---	FRONT	VERT	TOTAL	---	C1
W	22-10-4	-87	-87	---	FRONT	VERT	TOTAL	---	C1
X	24-10-4	-87	-87	---	FRONT	VERT	TOTAL	---	C1
Y	26-10-4	-87	-87	---	FRONT	VERT	TOTAL	---	C1
Z	14-10-4	-13	-13	---	FRONT	VERT	TOTAL	---	C1
AA	16-10-4	-13	-13	---	FRONT	VERT	TOTAL	---	C1
AB	18-10-4	-13	-13	---	FRONT	VERT	TOTAL	---	C1
AC	20-10-4	-13	-13	---	FRONT	VERT	TOTAL	---	C1
AD	22-10-4	-13	-13	---	FRONT	VERT	TOTAL	---	C1
AE	24-10-4	-13	-13	---	FRONT	VERT	TOTAL	---	C1
AF	26-10-4	-13	-13	---	FRONT	VERT	TOTAL	---	C1
AG	30-10-4	-13	-13	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007739 72

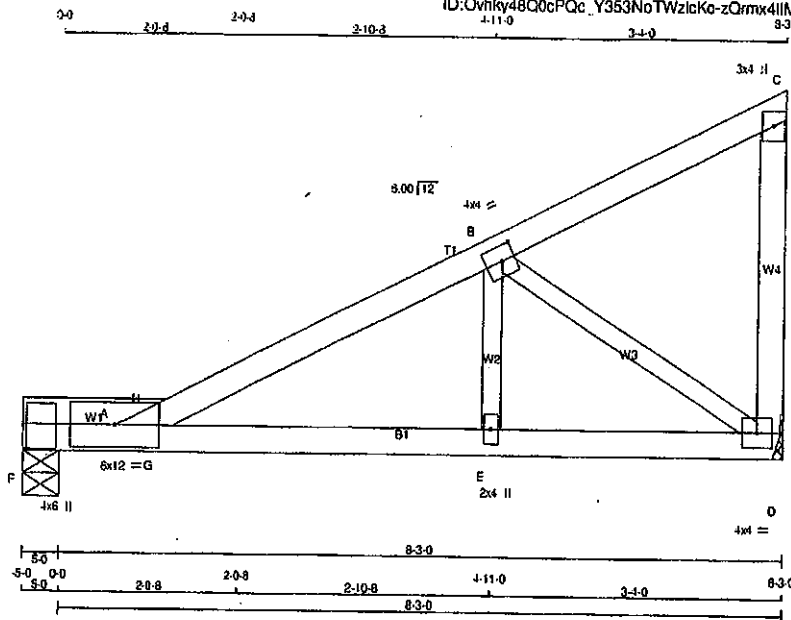

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE		LUMBER
A - C	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
F - A	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TBMWm	MT20	6.0	12.0	
B	TBMWV-i	MT20	4.0	4.0	2.00 1.75
C	TBMV+p	MT20	3.0	4.0	
D	BMWV1-t	MT20	4.0	4.0	
E	BMW+sw	MT20	2.0	4.0	
F	BMWV1*+m	MT20	4.0	6.0	3.25 0.50

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQD BRG
ST	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
D	478	0	478	0	0	MECHANICAL		
F	478	0	478	0	0	5-0	5-0	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

UNFACTORED REACTIONS

NOT LOGGED		BPA-WIND COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
D	338	222 0	0 0	0 0	0 0	118 0	0 0
F	338	222 0	0 0	0 0	0 0	118 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHO

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LO

10.12.2015 09:10:14

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
A-H	-831.0	-91.8	-91.8	0.21 (1)	E-B	0	0.04 (1)
H-B	-627.0	-91.8	-91.8	0.29 (1)	B-D	-715.0	0.18 (1)
B-C	-27.0	-91.8	-91.8	0.21 (1)	G-H	0	0.00 (1)
D-C	-93.0	0.0	0.0	0.02 (1)			
F-A	0.0	-110.3	-110.3	0.25 (1)			
A-G	0.602	-18.5	-18.5	0.69 (1)			
G-E	0.602	-18.5	-18.5	0.47 (1)			
E-D	0.602	-18.5	-18.5	0.23 (1)			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP	CH.	LL	=	25.6	PSF
		DL	=	6.0	PSF
BOT	CH.	LL	=	0.0	PSF
		DL	=	7.4	PSF
TOTAL LOAD				=	39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018 , OBC 2012 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.29")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.29")
CALCULATED VERT. DEFL.(TL) = L/708 (0.15")

CSI: TC=0.29/1.00 (B-H:1) , BC=0.69/1.00 (A-G:1) ,
WB=0.18/1.00 (B-D:1) , SSI=0.30/1.00 (A-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE ORIGIN


PLATE	GHIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1650

PLATE PLACEMENT TOL., = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.65 (D) INPUT = 0.90
JSI METAL = 0.86 (A) INPUT = 1.00


JST METAL= 0.26 (A) INPUT = 1.00

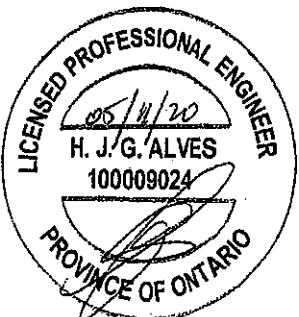

Structural component only
DWG# T-2009109

JOB NAME 408163	TRUSS NAME PB1	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:48:31 2020 Page 1
ID:KIHNL7kIaUBVUgBrpQW7E8z86y-??IZOla9Z4E5B7bi3XUJbJ6CZjnKh7IP6i4NurzPDXM

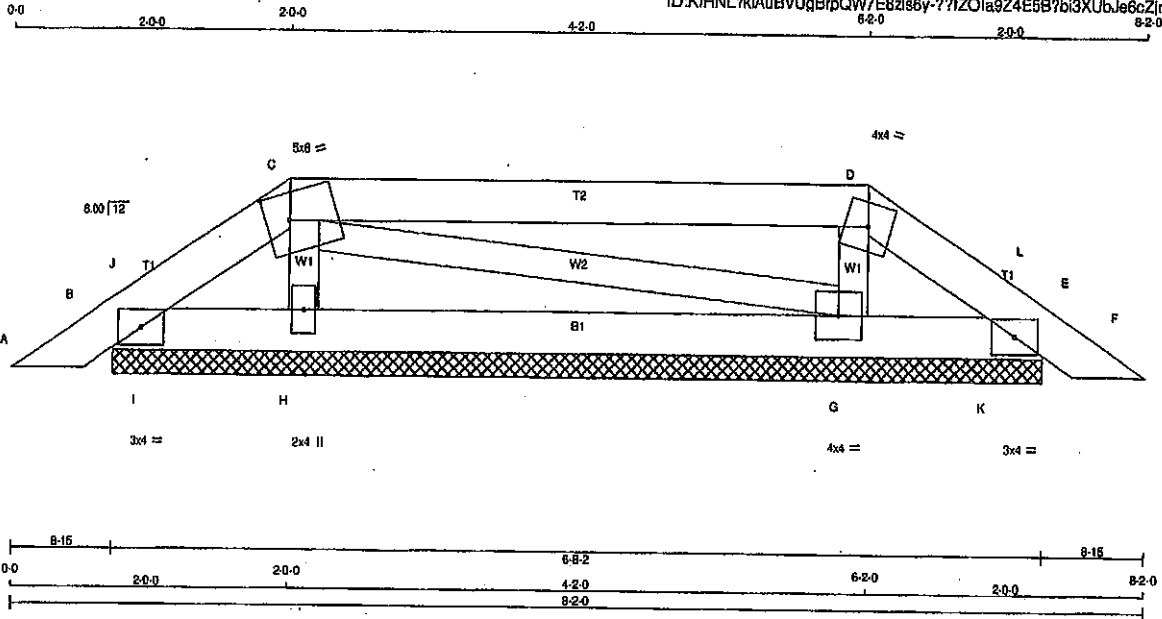

Scale = 1:14.9

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
B - E	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMB1-H	MT20	3.0	4.0
C	TTWW-m	MT20	5.0	8.0 2.25 2.00
D	TTWW-m	MT20	4.0	4.0
E	TMB1-L	MT20	3.0	4.0
G	BMWW1-H	MT20	4.0	4.0
H	BMWW1-w	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	HORZ	GROSS REACTION	JT	VERT	HORZ	GROSS REACTION	JT	VERT
B	145	0	145	0	0	0	6-8-2	6-8-2	6-8-2
E	141	0	141	0	0	0	6-8-2	6-8-2	6-8-2
H	283	0	283	0	0	0	6-8-2	6-8-2	6-8-2
G	289	0	289	0	0	0	6-8-2	6-8-2	6-8-2

UNFACTORED REACTIONS		1ST CASE		MAX./MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
B	99	83.0	0.0	0.0	0.0
E	97	81.0	0.0	0.0	0.0
H	202	121.0	0.0	0.0	0.0
G	208	125.0	0.0	0.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FORCE (LBS)
FR-TO		FROM TO	LENGTH FR-TO		
A-B	0/15	-91.8 -91.8 0.03 (1)	10.00	H-C	-203/0
B-J	-44/0	-91.8 -91.8 0.01 (4)	8.25	C-G	-8/0
J-C	-51/0	-91.8 -91.8 0.01 (1)	8.25	G-D	-208/0
C-D	-11/0	-91.8 -91.8 0.27 (1)	8.25	I-J	-88/0
D-L	-45/0	-91.8 -91.8 0.01 (1)	8.25	K-L	-89/0
L-E	-37/2	-91.8 -91.8 0.01 (4)	8.25		
E-F	0/15	-91.8 -91.8 0.03 (1)	10.00		
B-I	0/40	-18.5 -18.5 0.03 (1)	10.00		
I-H	0/40	-18.5 -18.5 0.03 (4)	10.00		
H-G	0/17	-18.5 -18.5 0.03 (4)	10.00		
G-K	0/35	-18.5 -18.5 0.03 (4)	10.00		
K-E	0/35	-18.5 -18.5 0.03 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2015, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.27/1.00 (C-D:1), 8C=0.05/1.00 (H-I:4), WB=0.03/1.00 (D-G:1), 5SI=0.15/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1887 788 1887 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.18 (D) (INPUT = 0.90)
JSI METAL= 0.05 (C) (INPUT = 1.00)

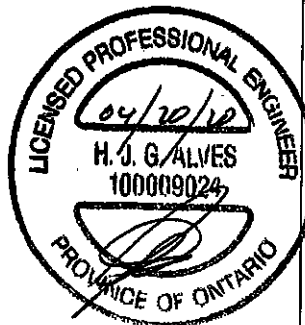


Structural component only
DWG# T-2006466

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408163	PB2	7	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Fri Apr 17 08:48:32 2020 Page 1
ID:KIHNL7kIAuBVUgBrpQW7E8zls8y-TCXcebnKNMyp9AudE?qsreqh76RQS7YLMqw01zP1XL

Scale = 1:18.9

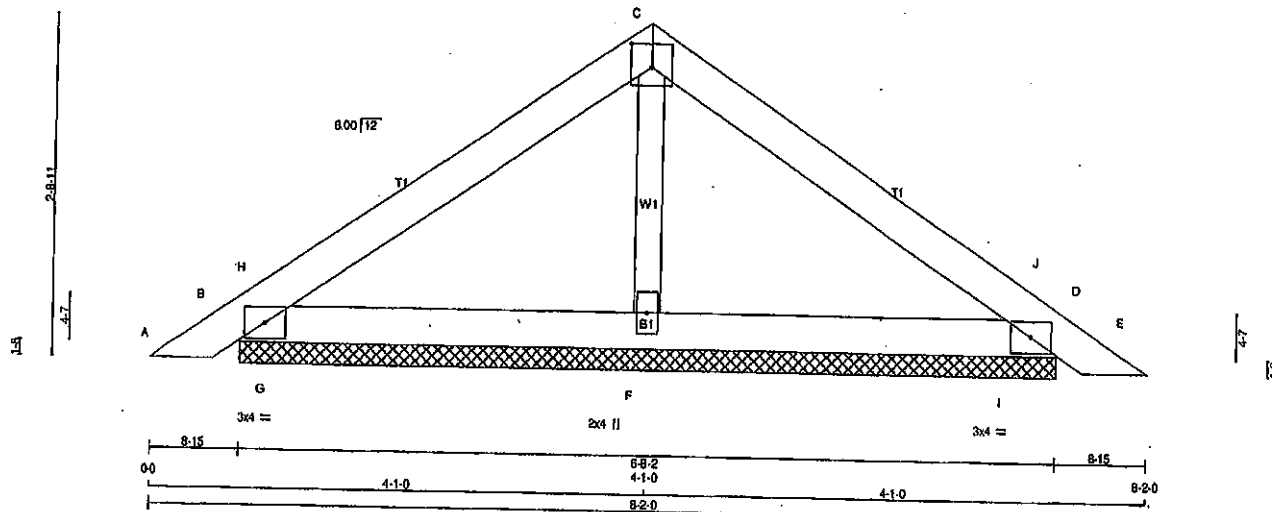

TOTAL WEIGHT = 7 X 20 = 143 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DRY
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
B - D	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
B	284	0	284	0	0
D	284	0	284	0	0
F	291	0	291	0	0


UNFACTORED REACTIONS		1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
B	198	142/0	0/0
D	198	142/0	0/0
F	208	125/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F
BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING		TOTAL LOAD CASES: (4)	
CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO	LENGTH FR-TO
A-B	0/15	-91.8 -91.8 0.03 (1)	10.00
B-H	-32/0	-91.8 -91.8 0.05 (1)	8.25
H-C	-111/0	-91.8 -91.8 0.12 (1)	6.25
C-J	-111/0	-91.8 -91.8 0.12 (1)	8.25
J-D	-32/0	-91.8 -91.8 0.05 (1)	6.25
D-E	0/15	-91.8 -91.8 0.03 (1)	10.00
B-G	0/88	-18.5 -18.5 0.12 (1)	10.00
G-F	0/88	-18.5 -18.5 0.12 (1)	10.00
F-I	0/88	-18.5 -18.5 0.12 (1)	10.00
I-D	0/88	-18.5 -18.5 0.12 (1)	10.00

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN. OC
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015
THIS DESIGN COMPLIES WITH:
- PART 8 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014
(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (C-H:1), BC=0.12/1.00 (B-G:1), WB=0.02/1.00 (C-F:1), SS=0.21/1.00 (B-G:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10
COMPANION LIVE LOAD FACTOR = 1.00
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.
NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658
PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.24 (B) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)

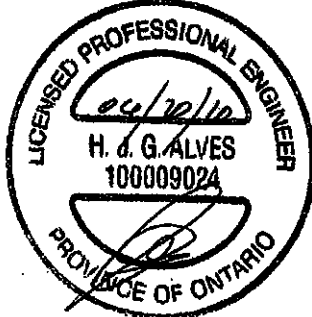


Structural component only
DWG# T-2006467

JOB NAME 408163	TRUSS NAME J1	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Fri Apr 17 08:46:21 2020 Page 1
ID: KIHNL?kIAuBVUgBrpQW7E8zls8y-H43nItuw?zW7TqnTQIFvXhxOhMTLTkwp8f7RzPIXW

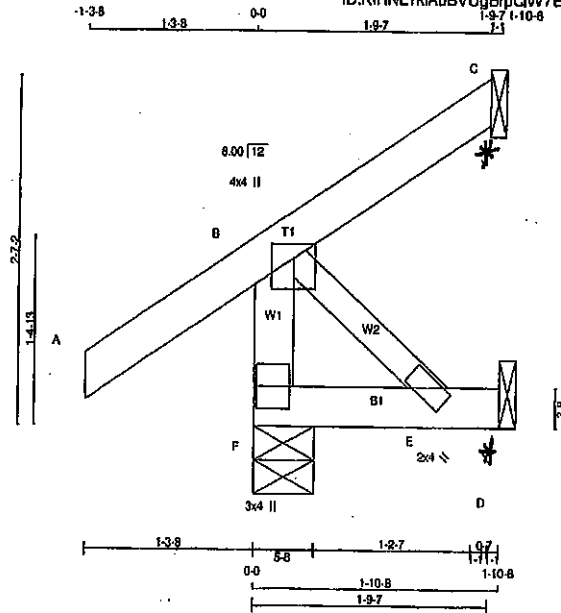

Scale = 1:15.8

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG	
VERT	HORZ	DOWN	HORZ	UPLIFT
IN-SX	IN-SX			
JT	274	0	274	0
F	34	0	34	0
C	17	0	17	0
D	17	0	17	0

TOTAL WEIGHT = 3 X 9 = 27 lb

DESIGN CRITERIA

SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (E-F:4), WB=0.00/1.00 (B-E:1), SS=0.03/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	818 354	1687 788	1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.18 (B) (INPUT = 0.90)
JSI METAL = 0.05 (B) (INPUT = 1.00)

PLATES (tablets in inches)	JT TYPE	PLATES	W	LEN	Y	X
S TMVW+p	MT20	4.0	4.0	1.25	2.00	
E BMVW+p	MT20	2.0	4.0			
F BMVW+p	MT20	3.0	4.0			

SEE MITTEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	190	143/0	0/0	0/0	0/0	47/0	0/0
C	23	19/-27	0/0	0/0	0/0	4/0	0/0
D	14	0/0	0/0	0/0	0/0	14/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)


CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CSI (LC)	UNBRACED LENGTH FR-TO
F-B	-258/0	0.0	0.0	0.03 (1)
A-B	0/35	-91.8	-91.8	0.12 (1)
B-C	-27/0	-91.8	-91.8	0.12 (1)
F-E	0/0	-18.5	-18.5	0.02 (4)
E-D	0/0	-18.5	-18.5	0.02 (4)

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN



Structural component only
DWG# T-2006458

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408163	J2	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 09:48:22 2020 Page 1					
ID:KIHNL7K1AuBVUgBrpQW7E8zls8y-iGc9WDTWhJ5NccPz18pUSKe4a5iHw_41qP0gtzPXV					
Scale = 1:22.6					

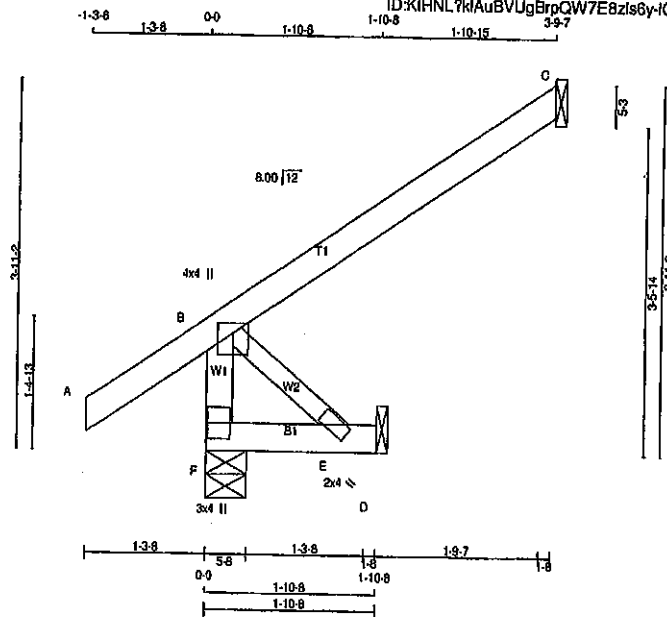

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMVW+w	MT20	2.0	4.0	
F	BMVt+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		RECORD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
F	317	0	317	0	0	5-8	5-8
C	174	0	174	0	0	1-8	1-8
D	17	0	19	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL 697791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST CASE		MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	220	167/0	0/0	0/0	0/0	53/0	0/0
C	120	97/0	0/0	0/0	0/0	23/0	0/0
D	14	0/0	0/0	0/0	0/0	14/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)
FR-TO			
F-B	-300/0	0.0 0.0 0.03 (1)	7.81
A-B	0/35	-91.8 -91.8 0.13 (5)	10.00
B-C	0/0	-91.8 -91.8 0.22 (1)	10.00
F-E	0/0	-18.5 -18.5 0.02 (4)	10.00
E-D	0/0	-18.5 -18.5 0.01 (4)	10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 12 = 35 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/360 (0.19")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.00")
ALLOWABLE DEFL.(TL) = 1/360 (0.19")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.00")

CS: TC=0.22/1.00 (B-C:1), BC=0.02/1.00 (E-F:4),
WB=0.00/1.00 (B-E:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.21 (B) (INPUT = 0.90)
JSI METAL = 0.08 (B) (INPUT = 1.00)

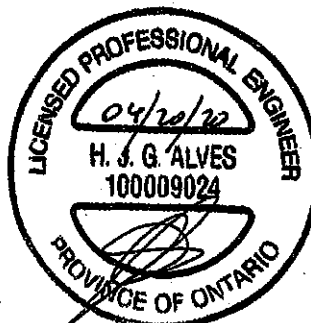

Structural component only
DWG# T-2006459

JOB NAME 408163	TRUSS NAME J3	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:48:24 2020 Page 1
ID:KIHNL7kAuBVUGBrpQW7E8zls6y-ilkvwwVmDwM5awZM9ZsyX9JScvMYyqTNV6uVWzPtXT
5-10-8

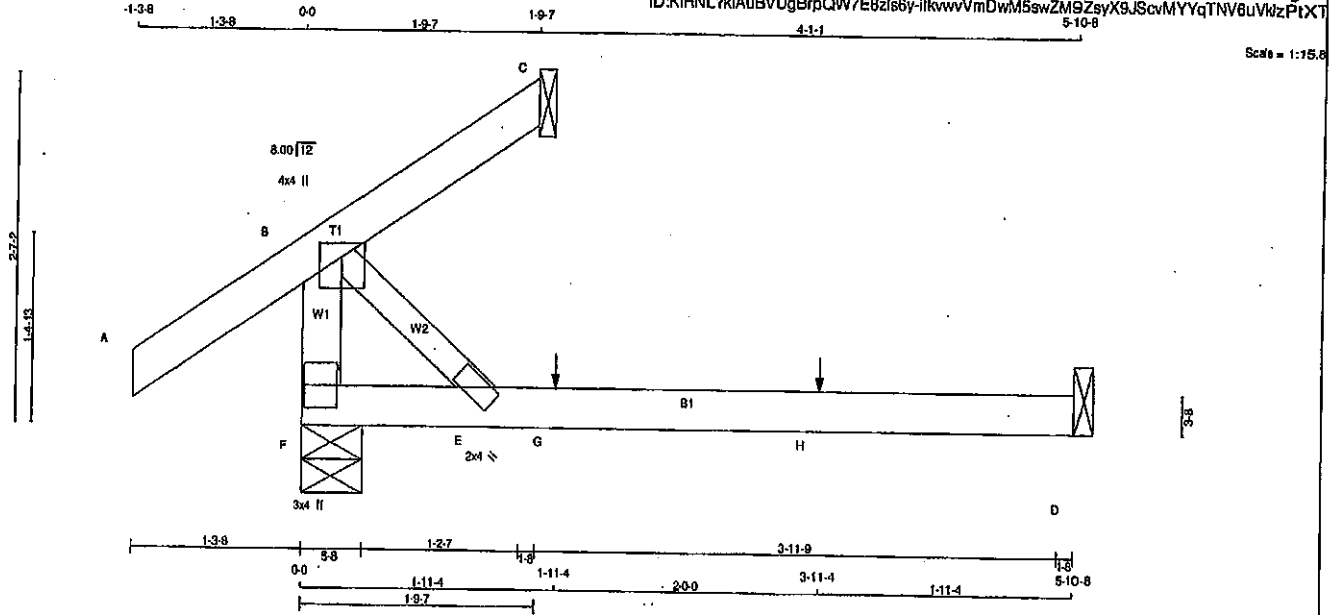

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMVW+p	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
F	311	0	311	0	5-8
C	34	0	34	0	1-8
D	54	0	61	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) F, C, D

UNFACTORED REACTIONS		1ST LCASE	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
JT	COMBINED							
F	220	143 / 0	0 / 0	0 / 0	0 / 0	0 / 0	77 / 0	0 / 0
C	23	19 / 0	0 / 0	0 / 0	0 / 0	0 / 0	4 / 0	0 / 0
D	43	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	43 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX. (LC)	MAX. UNBRACED LENGTH FR-TO	WEBS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED LC1 MAX. (LC)
FR-TO			FROM	TO				
F-B	-256 / 0	0.0	0.0	0.03 (1)	7.81	B-E	0 / 0	0.00 (1)
A-B	0 / 35	-91.8	-91.8	0.13 (1)	10.00			
B-C	-27 / 0	-91.8	-91.8	0.12 (1)	6.25			
F-E	0 / 0	-18.5	-18.5	0.13 (4)	10.00			
E-G	0 / 0	-18.5	-18.5	0.19 (4)	10.00			
G-H	0 / 0	-18.5	-18.5	0.19 (4)	10.00			
H-D	0 / 0	-18.5	-18.5	0.19 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)		JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	1-11-4	1	1	---	FRONT	VERT	TOTAL	---	---	---	C1
H	3-11-4	1	1	---	FRONT	VERT	TOTAL	---	---	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 3 X 13 = 40 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.12/1.00 (A-B:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.09/1.00 (B-C:1)

DOL LUMBER=0.98 NAIL=0.98 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1667 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)

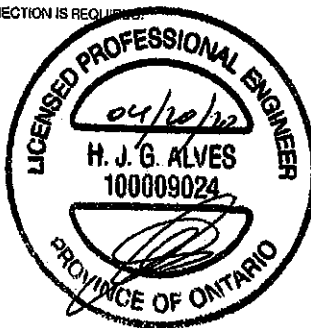


Structural component only
DWG# T-2006460

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408163	J4	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Fri Apr 17 08:46:25 2020 Page 1
ID:KHNL?kIAuBVUgBrpQW7E8zls6y-ArIH8FWO_EUxT47YkGNB4NsbaqlnHHjWkmd2GCzPlXS

Scale = 1:22.3

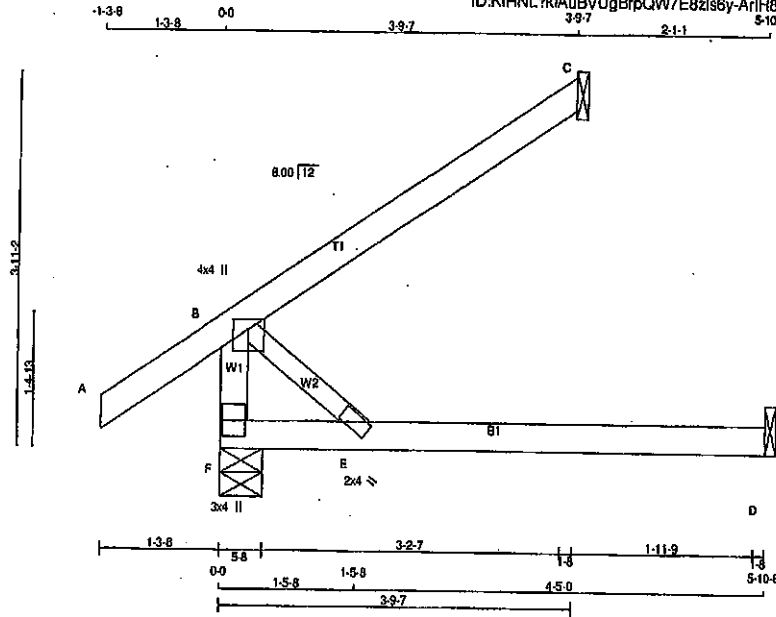

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMVW+w	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
F	354	0	354	0	0	5.8	5.8	5.8	5.8
C	174	0	174	0	0	1.8	1.8	1.8	1.8
D	54	0	61	0	0	1.8	1.8	1.8	1.8

SEE MITEK STANDARD DETAIL 897791 H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST LCASE		MAX/MIN. COMPONENT REACTIONS		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	DEAD	SOIL
F	250	187/0	0/0	0/0	0/0	83/0	0/0	0/0	0/0
C	120	97/0	0/0	0/0	0/0	23/0	0/0	0/0	0/0
D	43	0/0	0/0	0/0	0/0	43/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	MAX. CSI (LC)
FR-TO		FROM TO		FR-TO			
F-B	-300/0	0.0 0.0 0.03 (1)	7.81	B-E	0/0	0.00 (1)	
A-B	0/35	-91.8 -91.8 0.12 (1)	10.00				
B-C	0/0	-91.8 -91.8 0.22 (1)	10.00				
F-E	0/0	-18.5 -18.5 0.14 (4)	10.00				
E-D	0/0	-18.5 -18.5 0.19 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CSI: TC=0.22/1.00 (B-C:1), BC=0.18/1.00 (D-E:4),
WB=0.00/1.00 (B-E:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.21 (B) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)

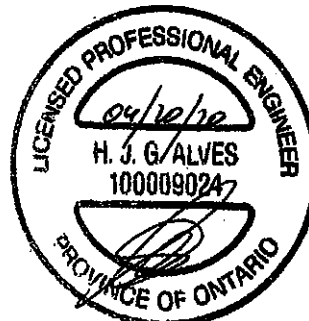


Structural component only
DWG# T-2006461

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408163	J5	11	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:46:28 2020 Page 1
ID:KIHNL7kIAuBVUgBrpQW7E8zls6y-e2sgLbX0IXco5EikG_uQcaOhf100kzgyQNopezPIXR

Scale = 1:28.8

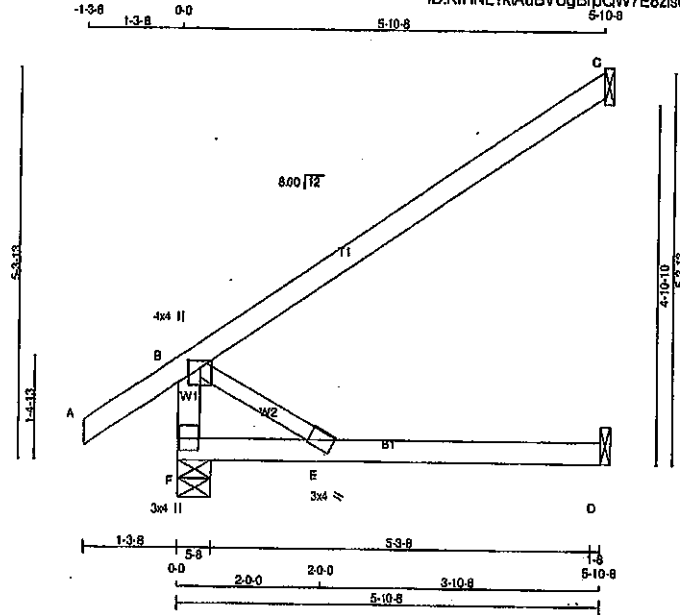

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	COMBINED	GROSS REACTION	GROSS REACTION	GROSS REACTION	GROSS REACTION	BRG	BRG	BRG	BRG
F	450	0	450	0	0	5-8	5-8	5-8	5-8
C	270	0	270	0	0	1-8	1-8	1-8	1-8
D	54	0	61	0	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST CASE		MAX/MIN COMPONENT REACTIONS		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL	DEAD	SOIL	DEAD	SOIL
F	316	221 / 0	0 / 0	0 / 0	0 / 0	86 / 0	0 / 0	86 / 0	0 / 0	86 / 0	0 / 0
C	186	150 / 0	0 / 0	0 / 0	0 / 0	35 / 0	0 / 0	35 / 0	0 / 0	35 / 0	0 / 0
D	43	0 / 0	0 / 0	0 / 0	0 / 0	43 / 0	0 / 0	43 / 0	0 / 0	43 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	CSH (LC)	MEMB.	FORCE (LBS)	CSH (LC)	MEMB.
F-B	-395 / 0	0.0	0.0 0.04 (1)	8-E	0 / 0	0.00 (1)	8-E
A-B	0 / 35	-91.8	-91.8 0.12 (1)				
B-C	0 / 0	-91.8	-91.8 0.54 (1)				
F-E	0 / 0	-18.5	-18.5 0.17 (4)				
E-D	0 / 0	-18.5	-18.5 0.19 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CSI: TC=0.54/1.00 (B-C:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.28 (B) (INPUT = 0.90)
JSI METAL=0.08 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006462

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Fri Apr 17 08:48:27 2020 Page 1
ID:KIHNL?kIAuBVUgBrpQW7E8z/s6y-6EQ2ZxXIWrkljOHxqhPf9oxz56PplBDpB469L4zP1XG

Scale = 1:16.8

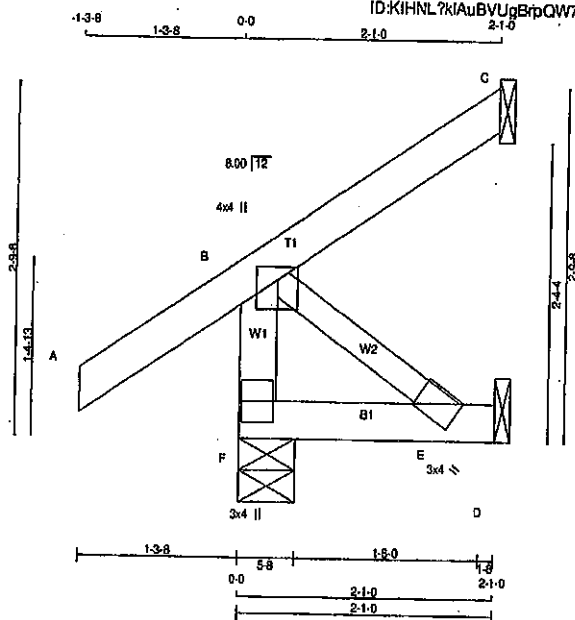

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY No.2	SPF
A - C	2x4	DRY No.2	SPF
F - D	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
DRY: SEASONED LUMBER			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMW+w	MT20	3.0	4.0	
F	BMVI+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT	REQD
JT	VERT	HORIZ	DOWN	HORIZ	UPLIFT	BRG	BRG
F	241	0	241	0	0	5-8	5-8
C	96	0	96	0	0	1-8	1-8
D	19	0	22	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C . D

UNFACTORED REACTIONS							
1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	168	124.0	0.0	0.0	0.0	44.0	0.0
C	68	53.0	0.0	0.0	0.0	13.0	0.0
D	15	0.0	0.0	0.0	0.0	15.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. FURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBB			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LOCAL CSI (LG)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LOCAL CSI (LG)
FR-TO		FROM TO		FR-TO			
F-B	-222 / 0	0.0 0.0	0.02 (1)	7.81	B-E	0 / 0	0.00 (1)
A-B	0 / 35	-91.8 -91.8	0.12 (5)	10.00			
B-C	0 / 0	-91.8 -91.8	0.07 (1)	10.00			
F-E	0 / 0	-18.5 -18.5	0.02 (4)	10.00			
E-D	0 / 0	-18.5 -18.5	0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT $\Rightarrow 5 \times 10 = 49 \text{ lb}$

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL	=	25.8 PSF
	DL	=	8.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.4 PSF
TOTAL LOAD		=	39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018 , OBC 2012 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:5), BC=0.02/1.00 (E-F:4),
WB=0.00/1.00 (B-E:1), SSI=0.08/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	GRIP (DRY)		SHEAR		SECTION	
	{PSI}		{PLI}		{PLI}	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.15 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)

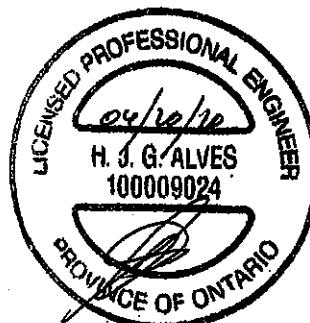


Structural component only
DWG# T-2006463

JOB NAME 408163	TRUSS NAME J8	QUANTITY 8	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 08:46:30 2020 Page 1
ID:KIHNH7kiAuBVUqBrpQW7E8zls6y-Wp5AByaXom6Ear0WVpyMnQZSWKPMYyFi2LpyPzPDXN

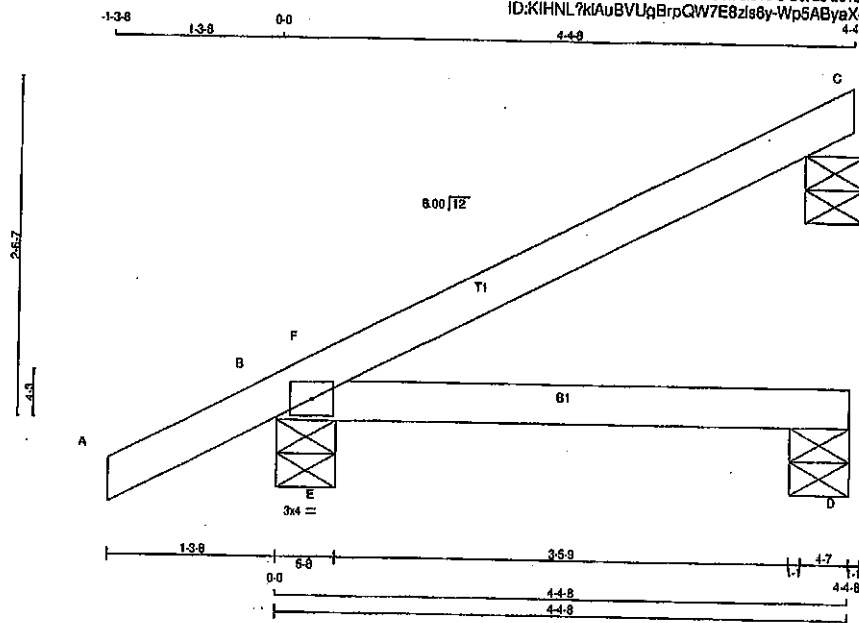

Scale: 3/4"=1'

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2	
B - D	2x4	DRY	No.2	

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMS1-1	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
C	175	0	175	0	5-8 (4-6)	5-8
B	386	0	386	0	5-8	5-8
D	68	0	68	0	5-8 (5-7)	5-8

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
C	121	94/0	0/0	0/0	0/0	27/0	0/0
B	256	181/0	0/0	0/0	0/0	75/0	0/0
D	49	18/0	0/0	0/0	0/0	32/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	MAX. UNBRAC LENGTH	WEBS MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO							
A-B	0/26	-91.8	-91.8	0.12 (1)	10.00		
B-F	-20/37	-91.8	-91.8	0.05 (1)	6.25	E-F -280/8	0.00 (1)
F-C	-3/2	-91.8	-91.8	0.23 (1)	10.00		
B-E	0/0	-18.5	-18.5	0.16 (1)	10.00		
E-D	0/0	-18.5	-18.5	0.16 (1)	10.00		

TOTAL WEIGHT = 8 X 12 = 96 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.02")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.04")

CSI: TO=0.23/1.00 (C-F:1), BC=0.16/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SSI=0.23/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)	
MAX	MIN	MAX	MIN
MT20	618	354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.29 (B) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006465

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408165	J21	6	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:44:08 2020 Page 1
ID:Ovhky48Q0cPQc_Y353NoTWzlcKo-gVWVOPsSF8DOX08DB7P30UhD04z4hKoMDyxlyezPiZb

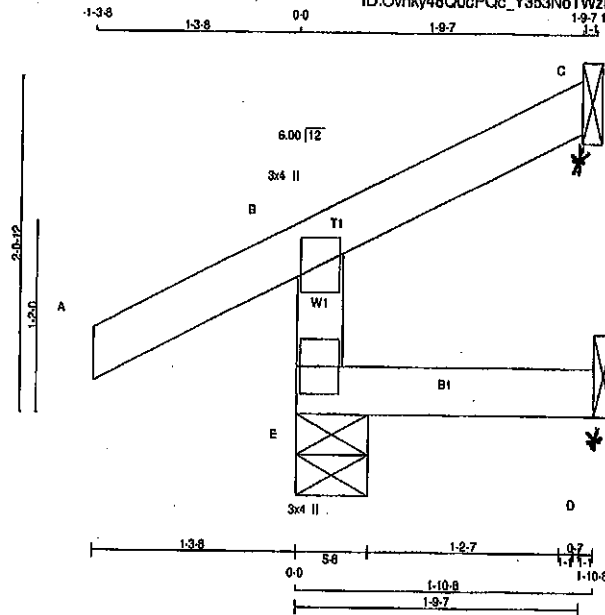

Scale = 1:13.1

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2	
A - C	2x4	DRY	No.2	
E - D	2x4	DRY	No.2	

DRY: SEASONED LUMBER.

DESCR.
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	DOWN	UP	BRG
JT	VERT	HORZ	DOWN	HORZ
E	271	0	271	0
C	45	0	45	0
D	8	0	17	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS	1ST LOASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW
E	188	141 / 0
C	31	24 / -18
D	7	0 / -8

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD	MEMB.	FORCE
FR-TO	(LBS)	(PLF)	CS (LC)	(LBS)
E-B	-244 / 0	0.0	0.0	0.04 (5)
A-B	0 / 28	-91.8	-91.8	0.12 (1)
B-C	-17 / 0	-91.8	-91.8	0.09 (1)
E-D	0 / 0	-18.5	-18.5	0.04 (5)

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 8 X 7 = 42 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
ROT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/G

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/380$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/989$ (0.00")
ALLOWABLE DEFL. (TL) = $L/380$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/989$ (0.00")

CS: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5),
WB=0.00/1.00 (A-B:1), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1567 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP=0.10 (E) (INPUT=0.80)
JSI METAL=0.07 (B) (INPUT=1.00)

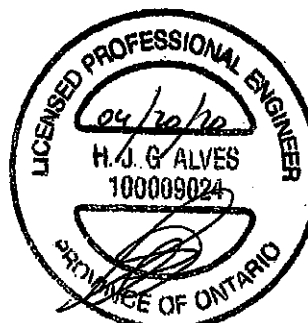


Structural component only
DWG# T-2006477

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408165	J22	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:44:08 2020 Page 1
ID:Ovhky48Q0cPQc_Y353NoTWzlcKo-9h4tbs50RLE9AKPdxIZhDM8UJeQn2VSchsV4zPLza

Scale = 1/16.2

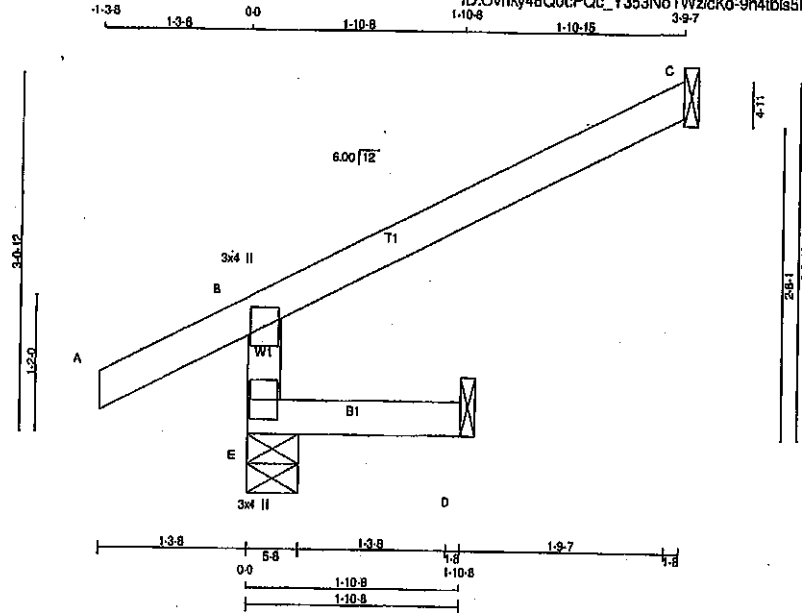

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
E	361	0	361	0	5-8	IN-SX
C	130	0	130	0	1-8	1-8
D	18	0	17	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX/MIN COMPONENT REACTIONS					
		SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
E	250	190 / 0	0 / 0	0 / 0	0 / 0	60 / 0	0 / 0
C	90	73 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0
D	12	0 / 0	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

FR-TO	CHORDS		FACTORED		WEBS	
	MAX. FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. VERT. LOAD (LBS)	MAX. HORZ. LOAD (LBS)	MAX. FORCE (LBS)	MAX. HORZ. LOAD (LBS)
E-B	-342 / 0	0.0	0.0	0.01 (4)	7.81	
A-B	0 / 28	-91.8	-91.8	0.13 (5)	10.00	
B-C	-19 / 0	-91.8	-91.8	0.22 (1)	6.25	
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2016, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/300 (0.19")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.00")
ALLOWABLE DEFL.(TL) = 1/300 (0.19")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.00")

CSI: TC=0.22/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.15/1.00 (B-C:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP=0.14 (E) (INPUT = 0.90)
JSI METAL=0.09 (B) (INPUT = 1.00)

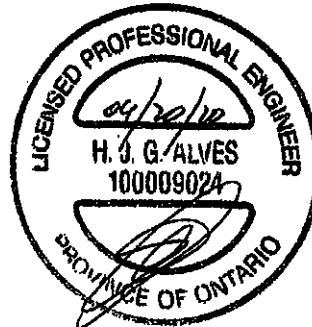


Structural component only
DWG# T-2006478

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408165	J24	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 2019 Mitek Industries, Inc. Fri Apr 17 08:44:11 2020 Page 1
ID:Ovhtky48Q0cPQc_Y353NaTWzckKo-53Cd0QuLX3byOUuos7zme6JhelzJuhYowwAzZzzPlZY

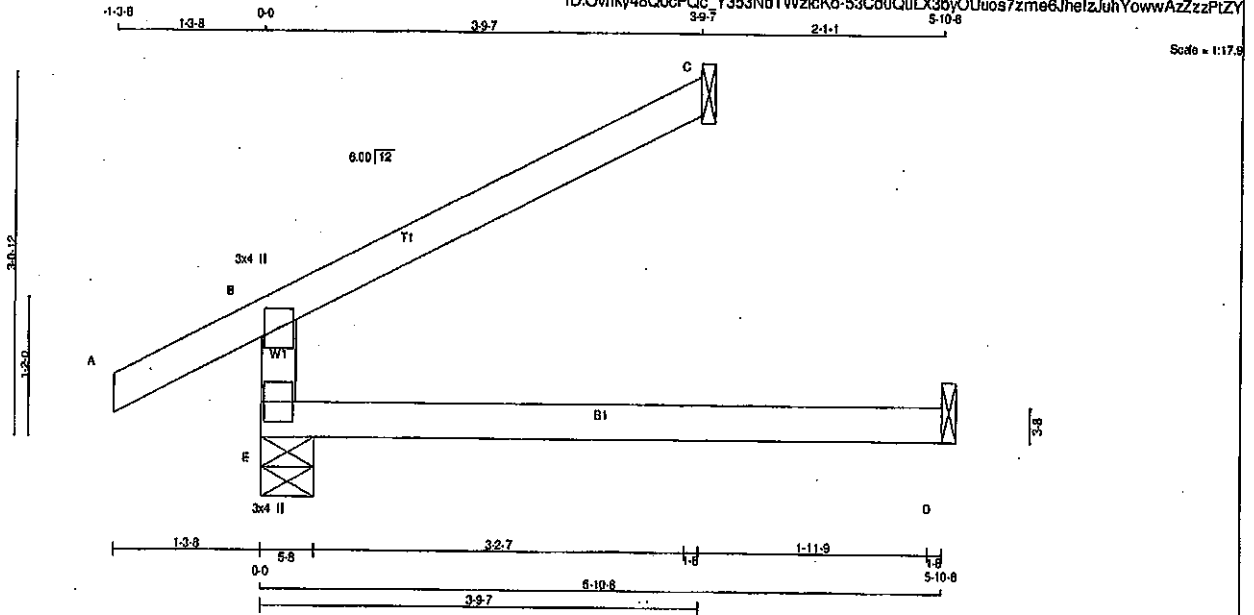

Scale = 1:17.9

<u>LUMBER</u>					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR.
E - B	2x4	DRY	No.2		SPF
A - C	2x4	DRY	No.2		SPF
E - D	2x4	DRY	No.2		SPF
DRY; SEASONED LUMBER.					

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
E	405	0	405	0	5-8	5-8
C	130	0	130	0	1-8	1-8
D	45	0	50	0	1-8	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
1ST CASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	286	190/0	0/0	0/0	0/0	98/0	0/0
C	90	73/0	0/0	0/0	0/0	17/0	0/0
D	36	0/0	0/0	0/0	0/0	36/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED VERT. LOAD (PLF)		MAX. UNBRACED LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)
			FROM	TO				
FR-TO								
E-B	-342/0	0.0	0.0	0.13 (4)	7.81			
A-B	0/28	-91.8	-91.8	0.12 (1)	10.00			
B-C	-19/0	-91.8	-91.8	0.22 (1)	8.25			
E-D	0/0	-18.5	-18.5	0.13 (4)	10.00			

TOTAL WEIGHT = 2 X 14 = 28 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	8.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 81.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.03")

CSI: TC=0.22/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (W:0), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	018 354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.14 (E) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)

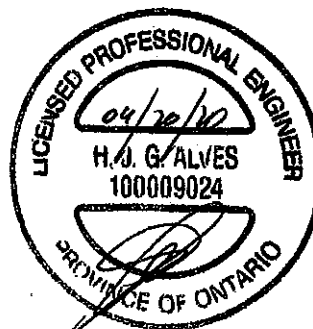

Structural component only
DWG# T-2006480

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408165	J25	11	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

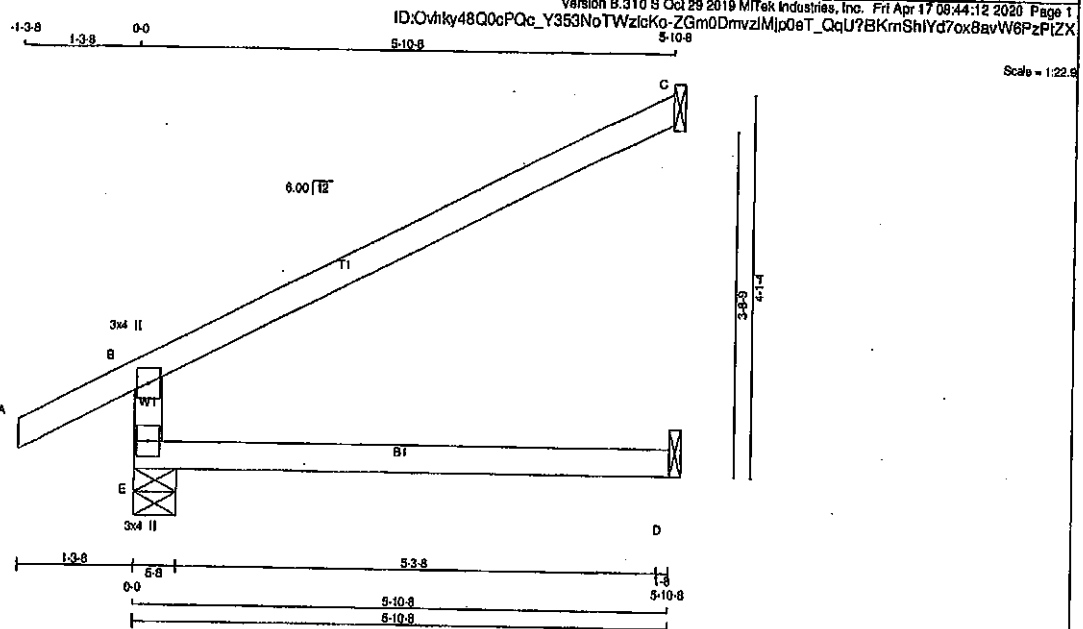

LUMBER
N. L. G. A. RULES
CHORDS SIZE DRY LUMBER
E - B 2x4 DRY No.2
A - C 2x4 DRY No.2
E - D 2x4 DRY No.2
DRY: SEASONED LUMBER.

PLATES (table in inches)
JT TYPE PLATES W LEN Y X
B TMV+p MT20 3.0 4.0
E BMV1+p MT20 3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	525	0	525	0	5-8	5-8
C	202	0	202	0	1-8	1-8
D	45	0	50	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	369	257.0	0.0	0.0	0.0	111.0	0.0
C	139	113.0	0.0	0.0	0.0	26.0	0.0
D	36	0.0	0.0	0.0	0.0	36.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	WEBS MAX. FACTORED FORCE (LBS)	
			CS1 (LC)	UNBRAC LENGTH FR-TO
FR-TO				
E-B	-481.0	0.0	0.0	7.81
A-B	0.28	-91.8	-91.8	10.00
B-C	-307.0	-91.8	-91.8	6.25
E-D	0.0	-18.5	-18.5	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIG 2011, TPIG 2014

DESIGN ASSUMPTIONS
OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (LL) = $L/989$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.03")

CSI: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SSI=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE .GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.19 (E) (INPUT = 0.90)
JSI METAL= 0.13 (B) (INPUT = 1.00)

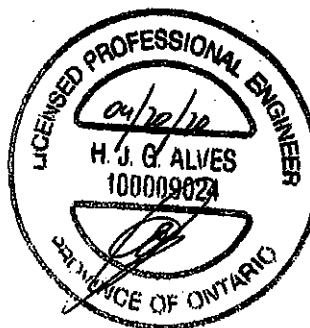

Structural component only
DWG# T-2006481

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408164	J26	9	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:55:30 2020 Page 1
ID:1ebEM4Ce92xn94Zv?kFPPlzmBR3-WDIdmG_7UJIKbQIMVLdkZnqnJND_mHU4qjDN?9zMDcR

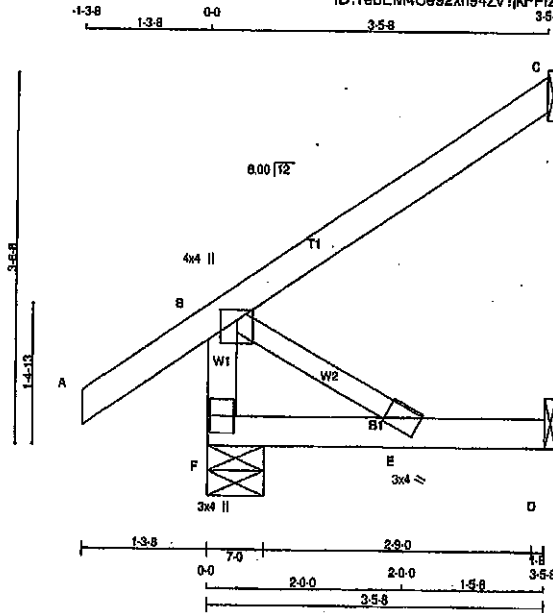

Scale = 1/2" = 1'-0"

LUMBER				DESCR.	
N. L. G. A. RULES	SIZE	LUMBER		SPF	
CHORDS					
F - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMVW+w	MT20	3.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	HORIZ	BRG	IN-SX	BRG	IN-SX
F	317	0	317	0	0	7-0	7-0		
C	159	0	159	0	0	1-8	1-8		
D	32	0	38	0	0	1-8	1-8		

SEE MTEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) F, C, D

UNFACTORED REACTIONS		1ST LCASE		MAX/MIN COMPONENT REACTIONS		SNOW		LIVE		PERM.LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	SNOW	LIVE	PERM.LIVE	WIND
F	222	159/0	0/0	0/0	0/0	53/0	0/0										
C	109	88/0	0/0	0/0	0/0	21/0	0/0										
D	26	0/0	0/0	0/0	0/0	26/0	0/0										

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		W E B S		FACTORED	
MEMB.	FORCE (LBS)	VERT.	LCI MAX	MEMB.	FORCE (LBS)	VERT.	LCI MAX
FR-TO		FROM	TO	FR-TO		FROM	TO
F-B	-285/0	0.0	0.0 0.03 (1)	B-E	0/0	0.00 (1)	
A-B	0/35	-91.8	-91.8 0.14 (5)				
B-C	0/0	-91.8	-91.8 0.19 (1)				
F-E	0/0	-18.5	-18.5 0.08 (4)				
E-D	0/0	-18.5	-18.5 0.08 (4)				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 9 X 14 = 122 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.19/1.00 (B-C:1), BC=0.08/1.00 (E-F:4), WB=0.00/1.00 (B-E:1), SSI=0.10/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 518 354 1867 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.20 (B) (INPUT = 0.80)
JSI METAL= 0.08 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007730

Tamarack Roof Truss, Burlington

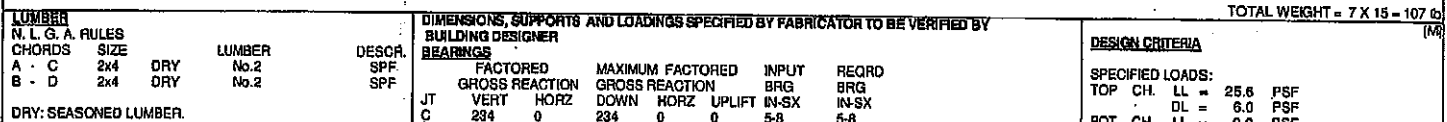

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

DESIGN CRITERIA

SPECIFIED LOADS:				
TOP	CH.	LL	=	25.6 PSF
		DL	=	6.0 PSF
BOT	CH.	LL	=	0.0 PSF
		DL	=	7.4 PSF
TOTAL LOAD			=	39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018 , OBC 2012 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= $L/360$ (0.19")
CALCULATED VERT. DEFL(LL) = $L/999$ (0.07")
ALLOWABLE DEFL.(TL)= $L/360$ (0.19")
CALCULATED VERT. DEFL(TL) = $L/501$ (0.14")

CSI: TC=0.41/1.00 (C-F:1), BC=0.28/1.00 (D-E:1),
WB=0.00/1.00 (E-F:1), SSI=0.27/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)		SHEAR		SECTION
	(PSI)		(PLI)		(PLI)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	618	354	1887	788	1887 1856

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.29 (B) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)



JOB NAME 408164	TRUSS NAME J28	QUANTITY 7	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

ID:1ebEM4Ce92xn84Zv7ikFPizmBR3-SbnOB0Y0N0wv2qksdIfCeCv7oBvSE8zN1tIU42zMDcP
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:55:32 2020 Page 1
Scale = 1:25.4

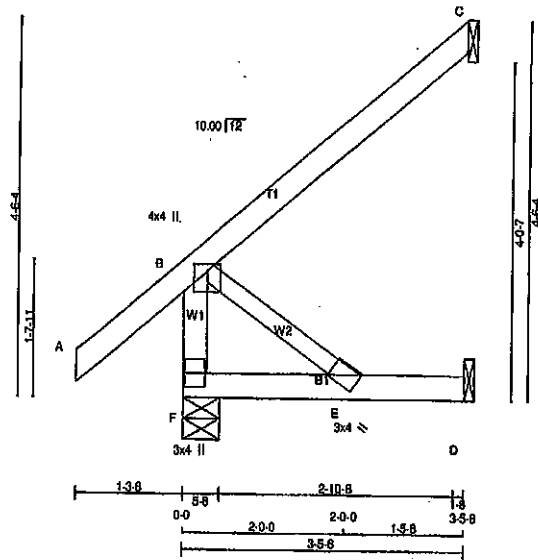

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
E	BMW+w	MT20	3.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
F	318	0	318	0	5-8	5-8	
C	159	0	159	0	1-8	1-8	
D	32	0	32	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		MAX./MIN. COMPONENT REACTIONS					
JT	1ST LOASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	222	159 / 0	0 / 0	0 / 0	0 / 0	63 / 0	0 / 0
C	109	88 / 0	0 / 0	0 / 0	0 / 0	21 / 0	0 / 0
D	26	0 / 0	0 / 0	0 / 0	0 / 0	28 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE	VERT.	LOAD	MEMB.	FORCE	MAX	
	(LBS)	(PLF)	LCI		(LBS)	CSI (LC)	
FR-TO		FROM	TO	FR-TO			
F-B	-288 / 0	0.0	0.0	0.03 (1)	7.81	0 / 0	0.00 (1)
A-B	0 / 41	-91.8	-91.8	0.14 (5)	10.00		
B-C	0 / 0	-91.8	-91.8	0.19 (1)	10.00		
F-E	0 / 0	-18.5	-18.5	0.06 (4)	10.00		
E-D	0 / 0	-18.5	-18.5	0.06 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 7 X 14 = 101 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 21.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/899 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/899 (0.01")

CSI: TC=0.19/1.00 (B-C:1), BC=0.08/1.00 (E-F:4),
WB=0.00/1.00 (B-E:1), SS=0.10/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.22 (B) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007732

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408165	J31	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:44:14 2020 Page 1					
ID:Ovhky48C0cPQo_Y353NoTWzlcKo-VelmeSwDq_zXFxcNXFWTGlxDJV0Q51IEcuOdAizPlZV					
Scale = 1:13.4					

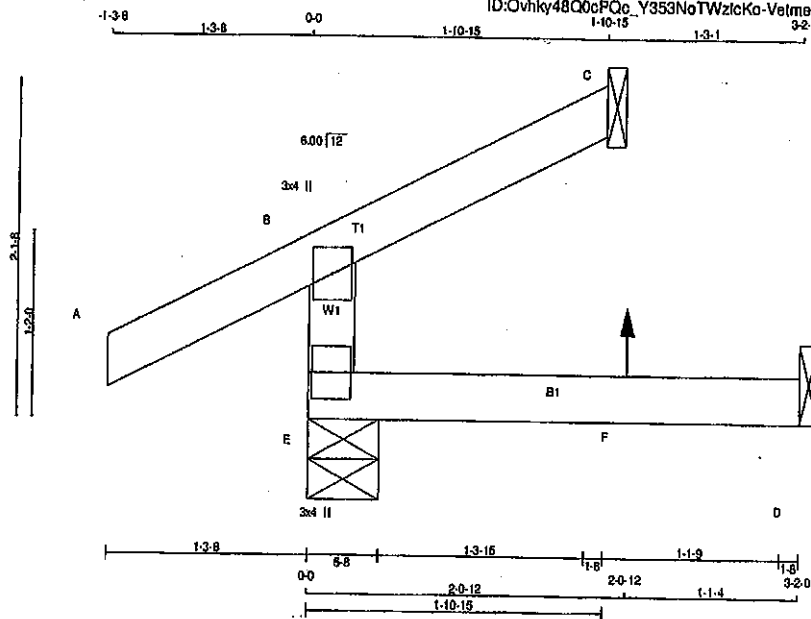

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

1920461596769064

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	JT	GROSS REACTION	BRG	IN-SX	BRG	IN-SX
E	204	0	204	0	0	5-8	5-8
C	68	0	68	0	0	1-8	1-8
D	21	0	28	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		MAX/MIN COMPONENT REACTIONS	
JT	COMBINED	JT	COMBINED
E	185	128	0
C	48	37	0
D	15	14	0

HORIZONTAL REACTIONS		MAX/MIN COMPONENT REACTIONS	
JT	COMBINED	JT	COMBINED
E	185	128	0
C	48	37	0
D	15	14	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (8)

CHORDS		WEBS	
MEMB.	FORCE	MEMB.	FORCE
FR-TO	FROM TO	FR-TO	FROM TO
E-B	-234 / 0	E-B	-18.5 / -18.5
A-B	0 / 28	A-B	-18.5 / -18.5
B-C	-10 / 0	B-C	-18.5 / -18.5
E-F	0 / 0	E-F	-18.5 / -18.5
F-D	0 / 0	F-D	-18.5 / -18.5

FACTORED CONCENTRATED LOADS (LBS)		FACE		DIR.		TYPE		HEEL		CONN.	
JT	LOC.	LOC.	LOC.	LOC.	LOC.	LOC.	LOC.	LOC.	LOC.	LOC.	LOC.
F	2-0-12	7	1	12	12	12	12	12	12	12	12

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 2 X 9 = 17 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/899 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/899 (0.00")

CSI: TC=0.13/1.00 (A-B-5), BC=0.04/1.00 (D-E-4), WB=0.00/1.00 (V-A-0), SS=0.10/1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.10 (E) (INPUT = 0.90)
JSI METAL=0.08 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006482

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408165	J32	3	1	TRUSS DESC.		

Tamarack Road Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:44:15 2020 Page 1
ID:Ovhtky4BQ0cPQc_Y353NoTWzlcKo-zrR8soxrbH50i5BZ5z1lpyTOhvMiqUXNqY8AikzPZU

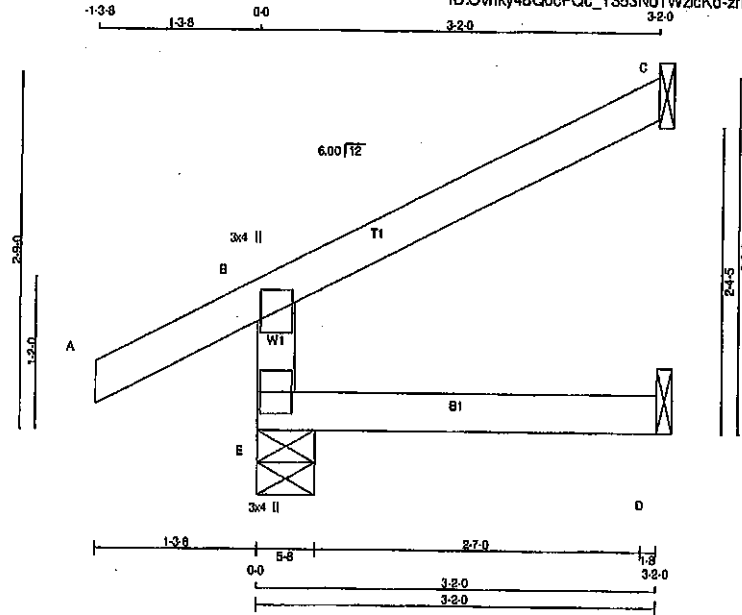

Scale = 1:16.4

LUMBER				
N. L. G. A. RULES	SIZE	LUMBER	DESCR.	SPF
CHORDS	2x4	DRY	No.2	SPF
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
E	339	0	339	0	5-8	5-8	5-8	5-8
C	109	0	109	0	1-8	1-8	1-8	1-8
D	25	0	25	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	COMBINED	MAX/MIN COMPONENT REACTIONS					
		SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
E	237	171/0	0/0	0/0	0/0	67/0	0/0
C	75	61/0	0/0	0/0	0/0	14/0	0/0
D	20	0/0	0/0	0/0	0/0	20/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (6)

FR-TO	CHORDS		FACTORED		WEBS		FACTORED	
	MEMB.	FORCE (LBS)	VERT.	LOAD (PLF)	MAX. MEMB. FORCE (LBS)	MAX. UNBRACED LENGTH	MAX. MEMB. FORCE (LBS)	MAX. UNBRACED LENGTH
E-B		-306/0	0.0	0.0	0.03 (4)	7.81		
A-B		0/28	-91.8	-91.8	0.13 (5)	10.00		
B-C		-16/0	-91.8	-91.8	0.16 (1)	8.25		
E-D		0/0	-18.5	-18.5	0.04 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 10 = 31 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIG 2011, TPIG 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.16/1.00 (B-C:1), BC=0.04/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SS=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	818 354	1887 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.13 (E) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)

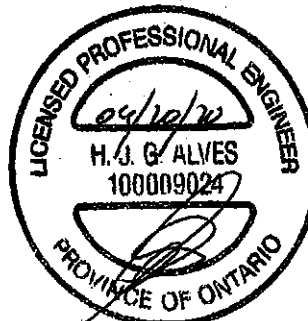

Structural component only
DWG# T-2006483

JOB NAME 408165	TRUSS NAME J33	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 9 Oct 2019 Mitek Industries, Inc. Fri Apr 17 08:44:16 2020 Page 1
ID:Ovhly48Q0cPQc_Y353NoTWzicKo-R1?W3ByUMbDFVfMlqZxLA0YZJgdZxnX3CikFAzPiZT

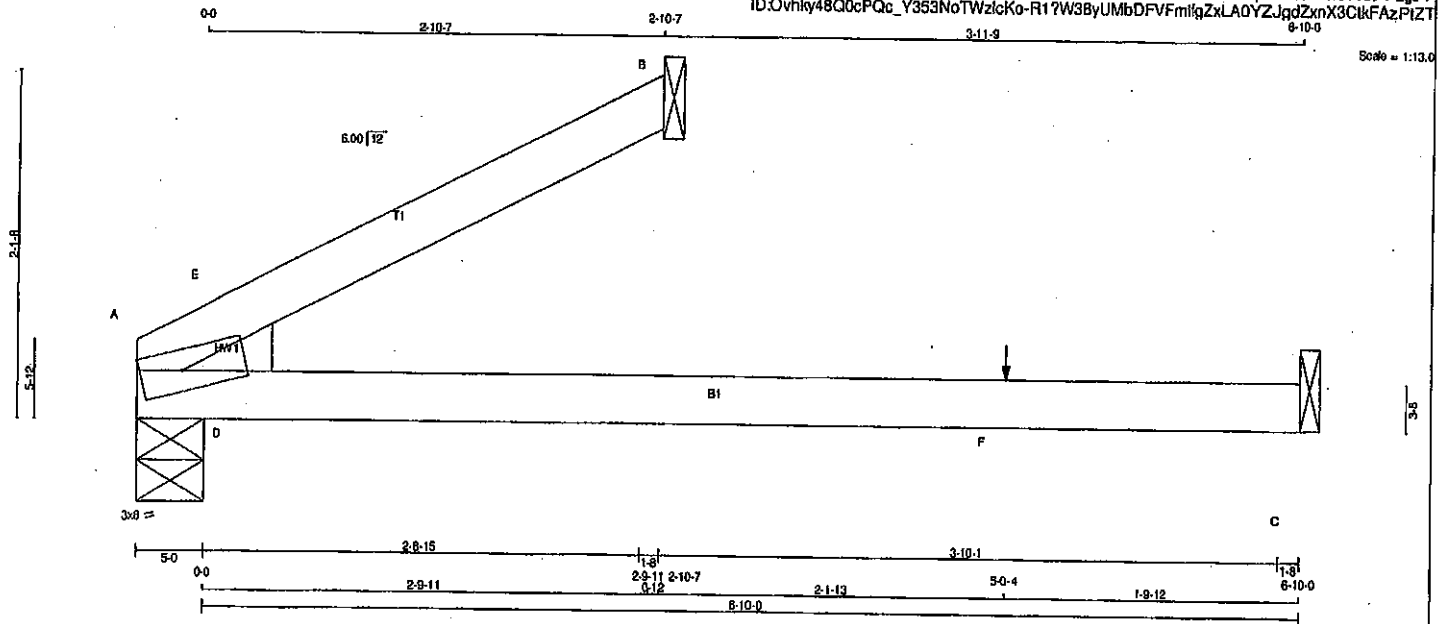

TOTAL WEIGHT = 13 lb (M/F)

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS		No.2	SPF
A - B	2x4	DRY	
A - C	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TBMH1-m	MT20	3.0	8.0 Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD	HEEL
JT	GROSS REACTION	GROSS REACTION	DOWN	UP	BRG	WEDGE
A	209	0	209	0	5-0	2x4 L
B	168	0	168	0	1-8	
C	60	0	61	0	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS		1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT	COMBINED							
A	150	89/0	0/0	0/0	0/0	61/0	0/0	0/0
B	118	75/0	0/0	0/0	0/0	43/0	0/0	0/0
C	47	4/0	0/0	0/0	0/0	43/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, B

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)	MAX	LC1 (LBS)
FR-TO		FROM	TO	FR-TO			
A-E	-113/0	-91.8	-91.8 0.18 (4)	D-E	0/163	0.00 (1)	
E-B	0/20	-91.8	-91.8 0.21 (4)				
A-D	0/0	-18.5	-18.5 0.11 (4)				10.00
D-F	0/0	-18.5	-18.5 0.19 (4)				10.00
F-C	0/0	-18.5	-18.5 0.19 (4)				10.00

FACTORED CONCENTRATED LOADS (LBS)		LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	5-0-4	1	1	--	--	FRONT	VERT	TOTAL	--	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.24")
CALCULATED VERT. DEFL.(LL) = L/899 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.24")
CALCULATED VERT. DEFL.(TL) = L/904 (0.10")

CSI: TC=0.21/1.00 (B-E:4), BC=0.19/1.00 (C-D:4), WB=0.00/1.00 (D-E:1), SS=0.15/1.00 (A-E:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MT20	618	354	1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.07 (A) (INPUT = 0.90)
JSI METAL = 0.01 (A) (INPUT = 1.00)

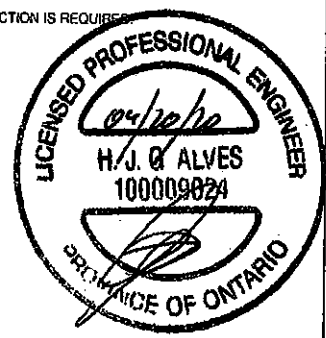

Structural component only
DWG# T-2006484

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408165	J34	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:44:17 2020 Page 1					
ID:Ovhky48Q0cPQc_Y353NoTWzlcKo-wDZvHUz67VL67PLYCO4AuNZhki?SIOtgsdHndzPIZS					
Scale = 1:17.9					

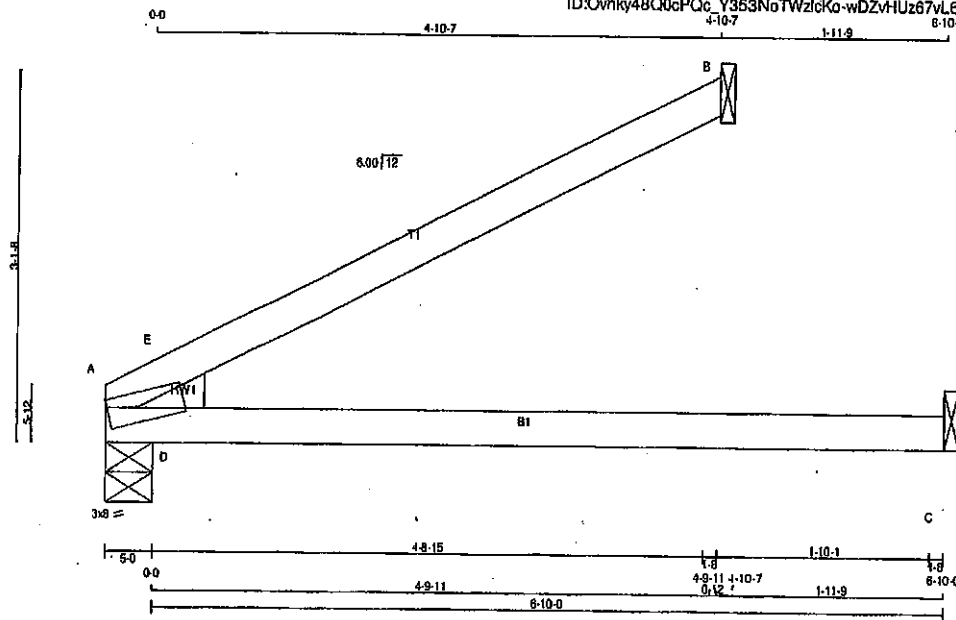

LUMBER			
N. L. G. A. RULES	SIZE	DRY	DESCR.
CHORDS	2x4	No.2	SPF
A - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
DRY, SEASONED LUMBER.			

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y
A	TBMH1-m	MT20	3.0	8.0
Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.				

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG		HEEL
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	WEDGE	
A	314	0	314	0	0	5-0	5-0	2x4 L	
B	225	0	225	0	0	1-8	1-8		
C	80	0	80	0	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS

JT	1ST CASE		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
A	223	140 / 0	0 / 0	0 / 0	0 / 0	83 / 0	0 / 0
B	157	117 / 0	0 / 0	0 / 0	0 / 0	40 / 0	0 / 0
C	61	13 / 0	0 / 0	0 / 0	0 / 0	48 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED	FACTORED	MAX. FACTORED	FACTORED
FR-TO	FORCE (LBS)	VERT. LOAD LC1 (PLF)	FORCE (LBS)	FORCE (LBS)
A-E	-73 / 0	-91.8 -91.8 0.12 (4)	6.25	0.00 (1)
E-B	0 / 7	-91.8 -91.8 0.38 (1)	10.00	
A-D	0 / 0	-18.5 -18.5 0.17 (1)	10.00	
D-C	0 / 0	-18.5 -18.5 0.23 (1)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.24")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.24")
CALCULATED VERT. DEFL.(TL) = L/455 (0.18")

CSI: TC=0.38/1.00 (B-E:1), BC=0.23/1.00 (C-D:1), WB=0.00/1.00 (D-E:1), SSI=0.18/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1856

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP = 0.15 (A) (INPUT = 0.90)
JSI METAL = 0.02 (A) (INPUT = 1.00)

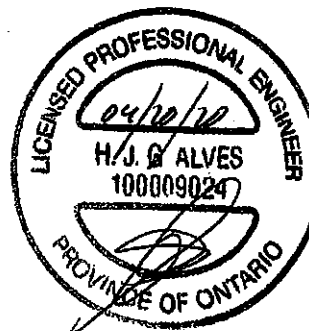

Structural component only
DWG# T-2006485

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408165	J35	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:44:18 2020 Page 1
ID:Ovhky48Q0cPQc_Y353N6TW2kK0-CQ7HUqzkuCUzkZw8m5bPQb5wZ6L1pBqXWMqJ3zPlZR

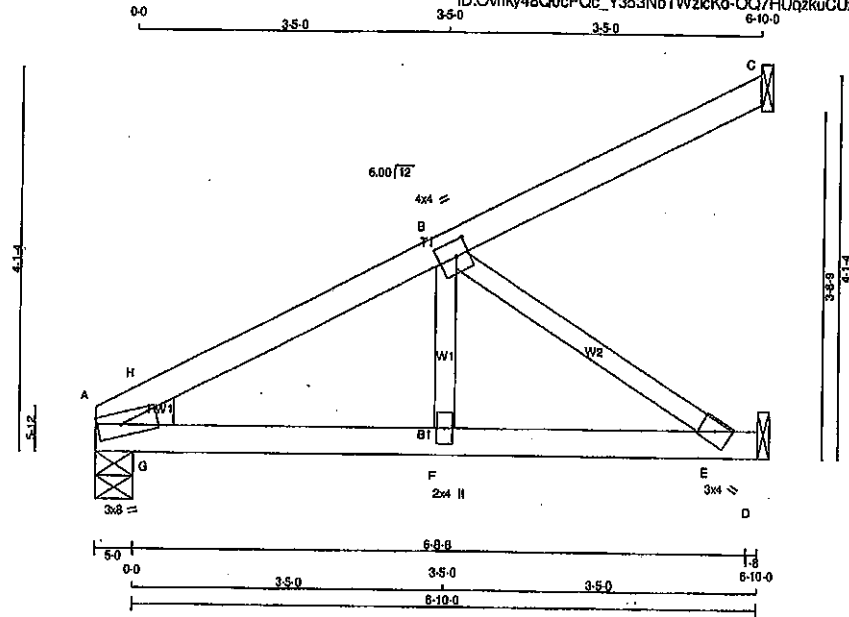

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			SPF
A - C	2x4	DRY	No.2
A - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TBMH1-m	MT20	3.0	8.0 Edge
B	TWVW-t	MT20	4.0	4.0 2.00 1.75
E	BMVW-w	MT20	3.0	4.0
F	BMVW-w	MT20	2.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD	HEEL
JT	GROSS REACTION	GROSS REACTION	DOWN	UPLIFT	IN-SX	WEDGE
A	400	0	400	0	5-0	5-0
C	125	0	125	0	1-8	1-8
D	275	0	275	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST LCASE	MAX/MIN COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT	COMBINED								
A	283	185/0	0/0	0-0	0-0	97-0	0-0	0-0	0-0
C	86	69/0	0/0	0-0	0-0	17-0	0-0	0-0	0-0
D	196	116/0	0/0	0-0	0-0	80-0	0-0	0-0	0-0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
A-H	-517 / 0	-91.8	-91.8 0.02 (1)	8.25	F-B	0 / 147	0.04 (4)
H-B	-461 / 0	-91.8	-91.8 0.12 (1)	8.25	B-E	-518 / 0	0.13 (1)
B-C	-14 / 0	-91.8	-91.8 0.11 (1)	8.25	G-H	-81 / 16	0.00 (1)
A-G	0 / 424	-18.5	-18.5 0.13 (1)	10.00			
G-F	0 / 424	-18.5	-18.5 0.14 (1)	10.00			
F-E	0 / 424	-18.5	-18.5 0.24 (1)	10.00			
E-D	0 / 0	-18.5	-18.5 0.17 (1)	10.00			

TOTAL WEIGHT = 3 X 23 = 68 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.24")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.24")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.12/1.00 (B-H:1), BC=0.24/1.00 (E-F:1),
WB=0.13/1.00 (B-E:1), SS=0.21/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1967 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.35 (E) (INPUT = 0.90)
JSI METAL= 0.19 (E) (INPUT = 1.00)



Structural component only
DWG# T-2006486

LUL/LUS/LJS/HUS/HHUS/HGUS

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.


Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1 1/2" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:



- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on p. 126.

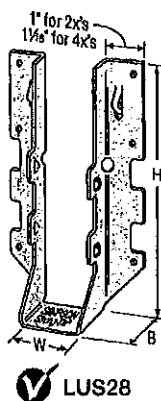


LUS28

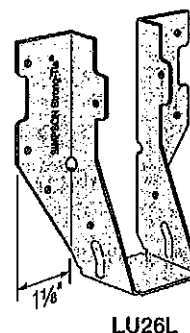

LU26L

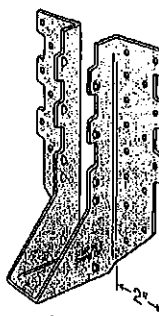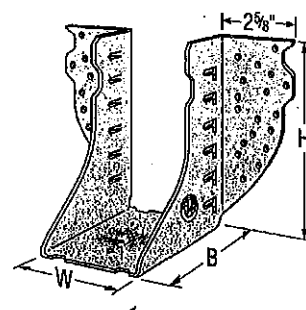HUS210
(HUS26, HUS28,
and HHUS similar)



HGUS28-2

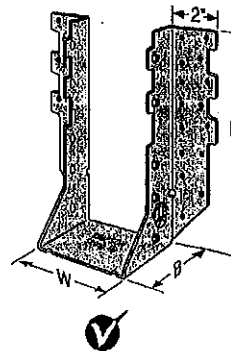

HHUS210-2

Double-Shear
Nailing
Top ViewDouble-Shear
Nailing
Side View;
Do not
bend tabDome Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 6,603,680

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

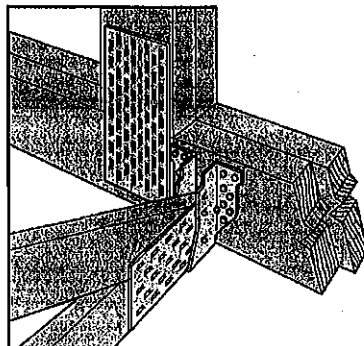

LJS26DS

LUL/LUS/LJS/HUS/HHUS/HGUS

HHUS/HGUS

See Hanger Options information on pp. 125–127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
$W < 2"$	Bevel or square cut	0.62 of table value	0.46 of table value
$2" < W < 6"$	Bevel cut	0.67 of table value	0.41 of table value
$2" < W < 6"$	Square cut	0.46 of table value	0.41 of table value
$W > 6"$	Bevel cut	0.75 of table value	0.41 of table value

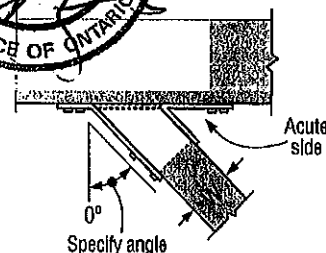

Top View HHUS Hanger
Skewed Right
(Joist must be bevel cut)
All joist nails installed on the
outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _a ^a	Header	Joist	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN	(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN
Single 2x Sizes											
LUS24	18	1⅞	3⅜	1⅜	2⅜	(4) 10d	(2) 10d	710	1625	645	1155
								316	723	287	514
LU24L	22	1⅞	3	1⅜	2⅞	(4) 10d	(2) 10d x 1½"	360	1020	320	725
								160	464	142	322
LU26L	22	1⅞	5	1⅜	4⅜	(6) 10d	(4) 10d x 1½"	720	1605	645	1140
								320	714	287	507
LUS26	18	1⅞	4⅜	1⅜	3⅜	(4) 10d	(4) 10d	1420	2170	1290	1630
								632	965	574	725
HUS26	16	1⅞	5⅜	3	3⅞	(14) 16d	(6) 16d	2705	4940	2065	3875
								1130	2197	920	1724
LJS26DS	18	1⅞	5	3½	4⅜	(16) 16d	(6) 16d	2055	4265	1480	4115
								914	1837	649	1831
HGUS26	12	1⅞	5⅜	5	4⅜	(20) 16d	(8) 16d	2685	6625	2685	5700
								1196	2961	1196	2535
LU28L	20	1⅞	6⅜	1⅜	5⅜	(8) 10d	(6) 10d x 1½"	1140	2185	1020	1550
								507	972	454	689
LUS28	18	1⅞	6⅜	1⅜	3⅜	(6) 10d	(4) 10d	1420	2520	1290	1790
								632	1121	574	796
HUS28	16	1⅞	7⅞	3	6⅞	(22) 16d	(8) 16d	3605	5365	2675	4345
								1604	2386	1190	1933
HGUS28	12	1⅞	7⅞	5	6⅞	(36) 16d	(12) 16d	3310	7675	3310	6900
								1474	3419	1474	3073
LU210L	20	1⅞	8	1⅜	7⅞	(10) 10d	(6) 10d x 1½"	1140	2495	1020	1770
								507	1110	454	787
LUS210	18	1⅞	7⅞	1⅜	3⅜	(8) 10d	(4) 10d	1420	2785	1290	2210
								632	1239	574	983

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_g is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (In.)				Fasteners			Factored Resistance						
		W	H	B	d _h ³	Header	Joist	D-Fir-L		S-P-F					
								Uplift	Normal	Uplift	Normal				
								(K _D = 1.15) lb.	(K _D = 1.00) lb.	(K _D = 1.15) lb.	(K _D = 1.00) lb.				
												kN	kN	kN	kN
Double 2x Sizes															
LUS24-2	18	3 3/8	3 3/8	2	1 1/2	(4) 16d	(2) 16d	835	2020	590	1435				
								3.71	8.99	2.82	6.38				
LUS26-2	18	3 3/8	4 3/8	2	4	(4) 16d	(4) 16d	1720	2595	1545	1920				
								7.65	11.54	6.87	8.54				
HHUS26-2	14	3 3/8	5 3/8	3	3 1/8	(14) 16d	(6) 16d	2850	7335	2065	5205				
								12.68	32.63	9.20	23.15				
HGUS26-2	12	3 3/8	5 3/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355				
								19.51	39.81	13.83	28.27				
LUS28-2	18	3 3/8	7	2	4	(6) 16d	(4) 16d	1720	3325	1545	2575				
								7.65	14.79	6.87	11.45				
HHUS28-2	14	3 3/8	7 3/8	3	6 3/8	(22) 16d	(8) 16d	3765	8940	2675	6345				
								16.75	39.77	11.90	28.22				
HGUS28-2	12	3 3/8	7 3/8	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215				
								27.00	57.74	19.17	40.99				
LUS210-2	18	3 3/8	9	2	6	(8) 16d	(6) 16d	2580	4500	2320	3195				
								11.48	20.02	10.32	14.21				
HHUS210-2	14	3 3/8	9 3/8	3	8	(30) 16d	(10) 16d	4670	9660	4235	7000				
								20.77	42.97	18.84	31.14				
HGUS210-2	12	3 3/8	9 3/8	4	8 3/8	(46) 16d	(16) 16d	6840	14015	4855	10270				
								30.43	62.34	21.60	45.69				
Triple 2x Sizes															
HGUS26-3	12	4 1/8	5 1/2	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355				
								19.51	39.81	13.83	28.27				
HGUS28-3	12	4 1/8	7 1/4	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215				
								27.00	57.74	19.17	40.99				
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d	4670	9670	4235	6865				
								20.77	43.02	18.84	30.54				
HGUS210-3	12	4 1/8	9 1/4	4	8 3/8	(46) 16d	(16) 16d	6840	14645	4855	10400				
								30.43	66.14	21.60	46.26				
Quadruple 2x Sizes															
HGUS26-4	12	6 3/8	5 3/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355				
								19.51	39.81	13.83	28.27				
HGUS28-4	12	6 3/8	7 3/8	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215				
								27.00	57.74	19.17	40.99				
HHUS210-4	14	6 3/8	8 3/8	3	7 1/8	(30) 16d	(10) 16d	4670	10155	4235	7210				
								20.77	45.17	18.84	32.07				
HGUS210-4	12	6 3/8	9 3/8	4	8 3/8	(46) 16d	(16) 16d	6840	14645	4855	10400				
								30.43	66.14	21.60	46.26				
HGUS212-4	12	6 3/8	10 3/8	4	10 3/8	(56) 16d	(20) 16d	7640	14995	5425	10645				
								33.98	66.70	24.13	47.35				
HGUS214-4	12	6 3/8	12 3/8	4	11 3/8	(68) 16d	(22) 16d	10130	16400	7195	11645				
								45.06	72.95	32.00	51.80				
4x Sizes															
LUS46	18	3 3/8	4 3/8	2	3 3/8	(4) 16d	(4) 16d	1720	2595	1545	1920				
								7.65	11.54	6.87	8.54				
HHUS46	14	3 3/8	5 3/8	3	3 1/8	(14) 16d	(6) 16d	2540	7335	2065	5205				
								11.30	32.63	9.20	23.15				
HGUS46	12	3 3/8	5 3/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355				
								19.51	39.81	13.83	28.27				
LUS48	18	3 3/8	6 3/8	2	3 3/8	(6) 16d	(4) 16d	1720	3325	1545	2575				
								7.65	14.79	6.87	11.45				
HHUS48	14	3 3/8	7 3/8	3	6 3/8	(22) 16d	(8) 16d	3765	8940	2675	6345				
								16.75	39.77	11.90	28.22				
HGUS48	12	3 3/8	7 3/8	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215				
								27.00	57.74	19.17	40.99				
LUS410	18	3 3/8	8 3/8	2	5 3/8	(8) 16d	(6) 16d	2580	4500	2320	3195				
								11.48	20.02	10.32	14.21				
HGUS410	12	3 3/8	9	4	8 3/8	(46) 16d	(16) 16d	6840	14015	4855	10270				
								30.43	62.34	21.60	45.69				
HGUS412	12	3 3/8	10 3/8	4	10 3/8	(56) 16d	(20) 16d	7640	14995	5425	10645				
								33.98	66.70	24.13	47.35				
HGUS414	12	3 3/8	12 3/8	4	11 3/8	(68) 16d	(22) 16d	10130	16400	7195	11645				
								45.06	72.95	32.00	51.80				


TN 15-001
Piggyback Bracing

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

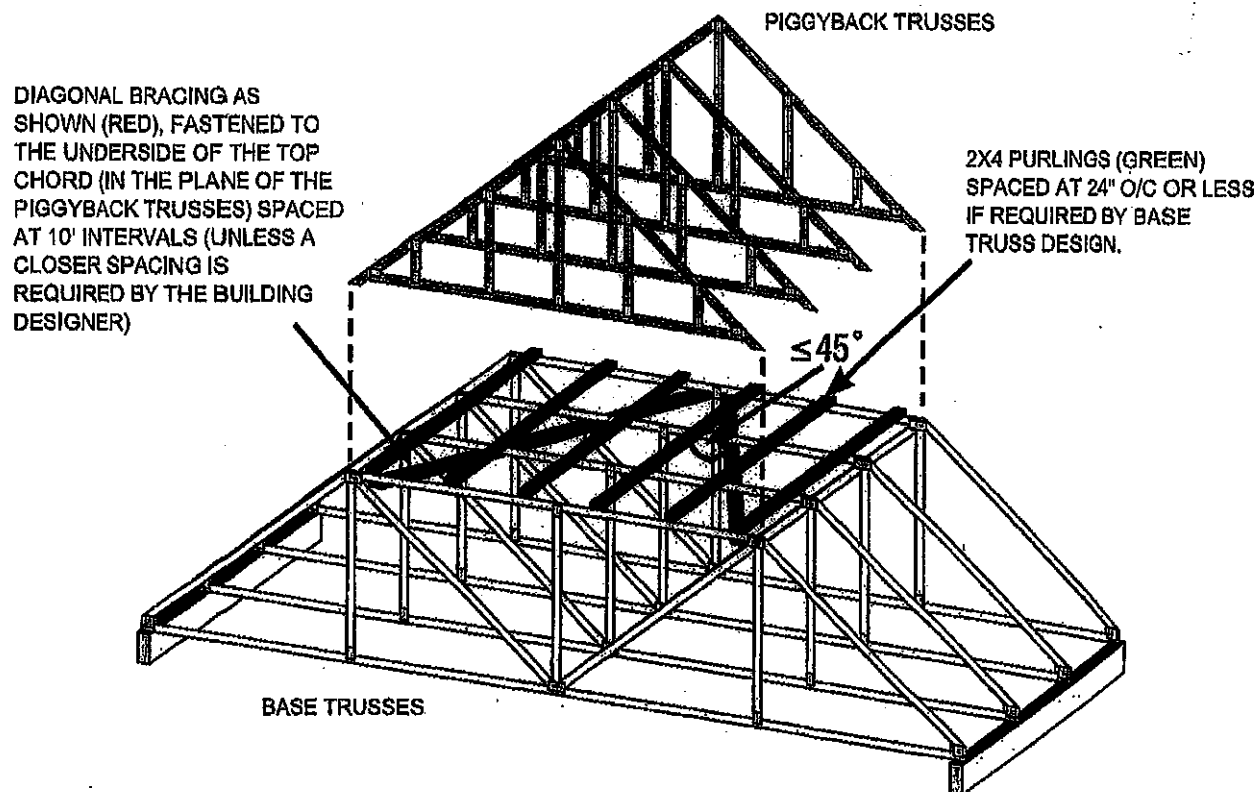

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

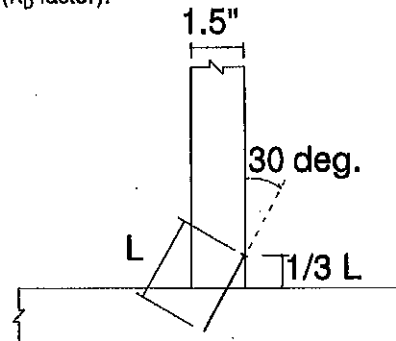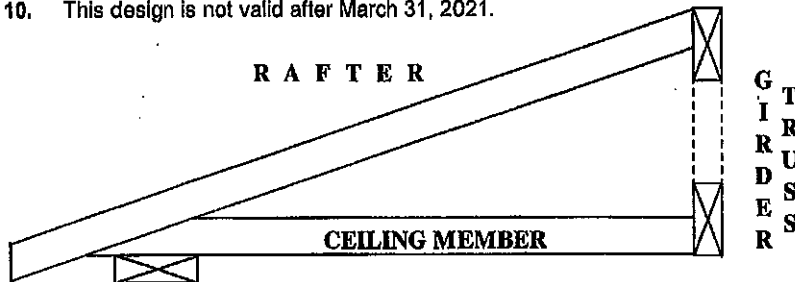

TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019

BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind** or **earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

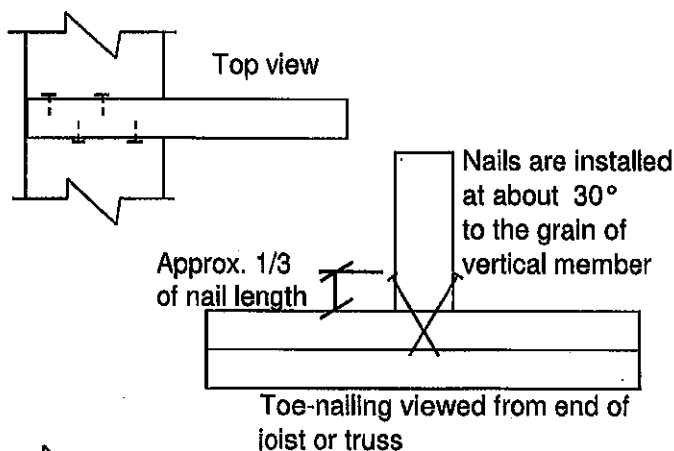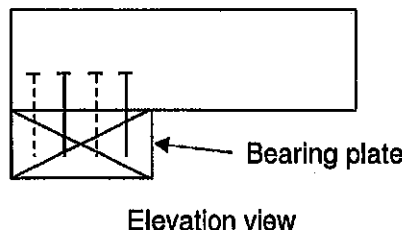

Toe-nailing on 2x4 Bearing Plate

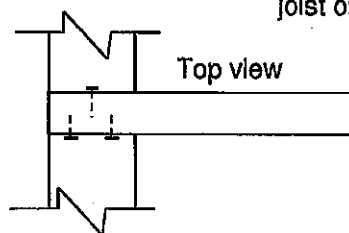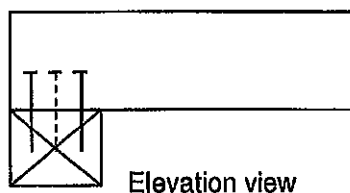


MiTek®

MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7


December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0- $\frac{1}{16}$ " from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm
(Drawings not to scale)

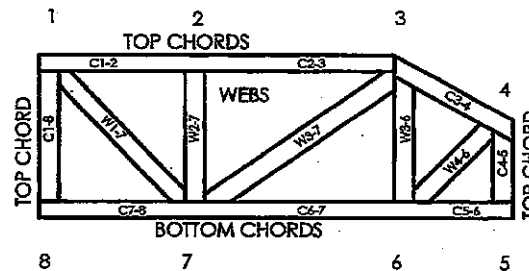

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MII-7473C rev. 10-08



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing of 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

1-Alves Engineering Services Inc. Is responsible for the design of trusses as individual components

2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.

3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.

4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.

5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.

2- Lumber is to be the sizes and grade specified on the truss drawing.

3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.

4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings

5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.

6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)

7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.

8- Refer to Miltek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1900218

Feb 09, 2018