

FROM PLAN DATED:

BUILDER: GREEN PARK HOMES

SITE: RUSSELL GARDENS PH 3

MODEL: MOUNTAINASH 6

ELEVATION: 2

LOT:

CITY: WATERDOWN

SALESMAN: MARIO DICIANO

DESIGNER: AJ

REVISION:

NOTES:

REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION.

SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING CANT' OVER BRICK RE I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7, TABLES 1 & 2. **CERAMIC TIL** APPLICATION AS PER O.B.C 9.30.6.

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²


DEAD LOAD: 20.0 lb/ft²

SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 2020-04-16

1st FLOOR

DECK CONDITION

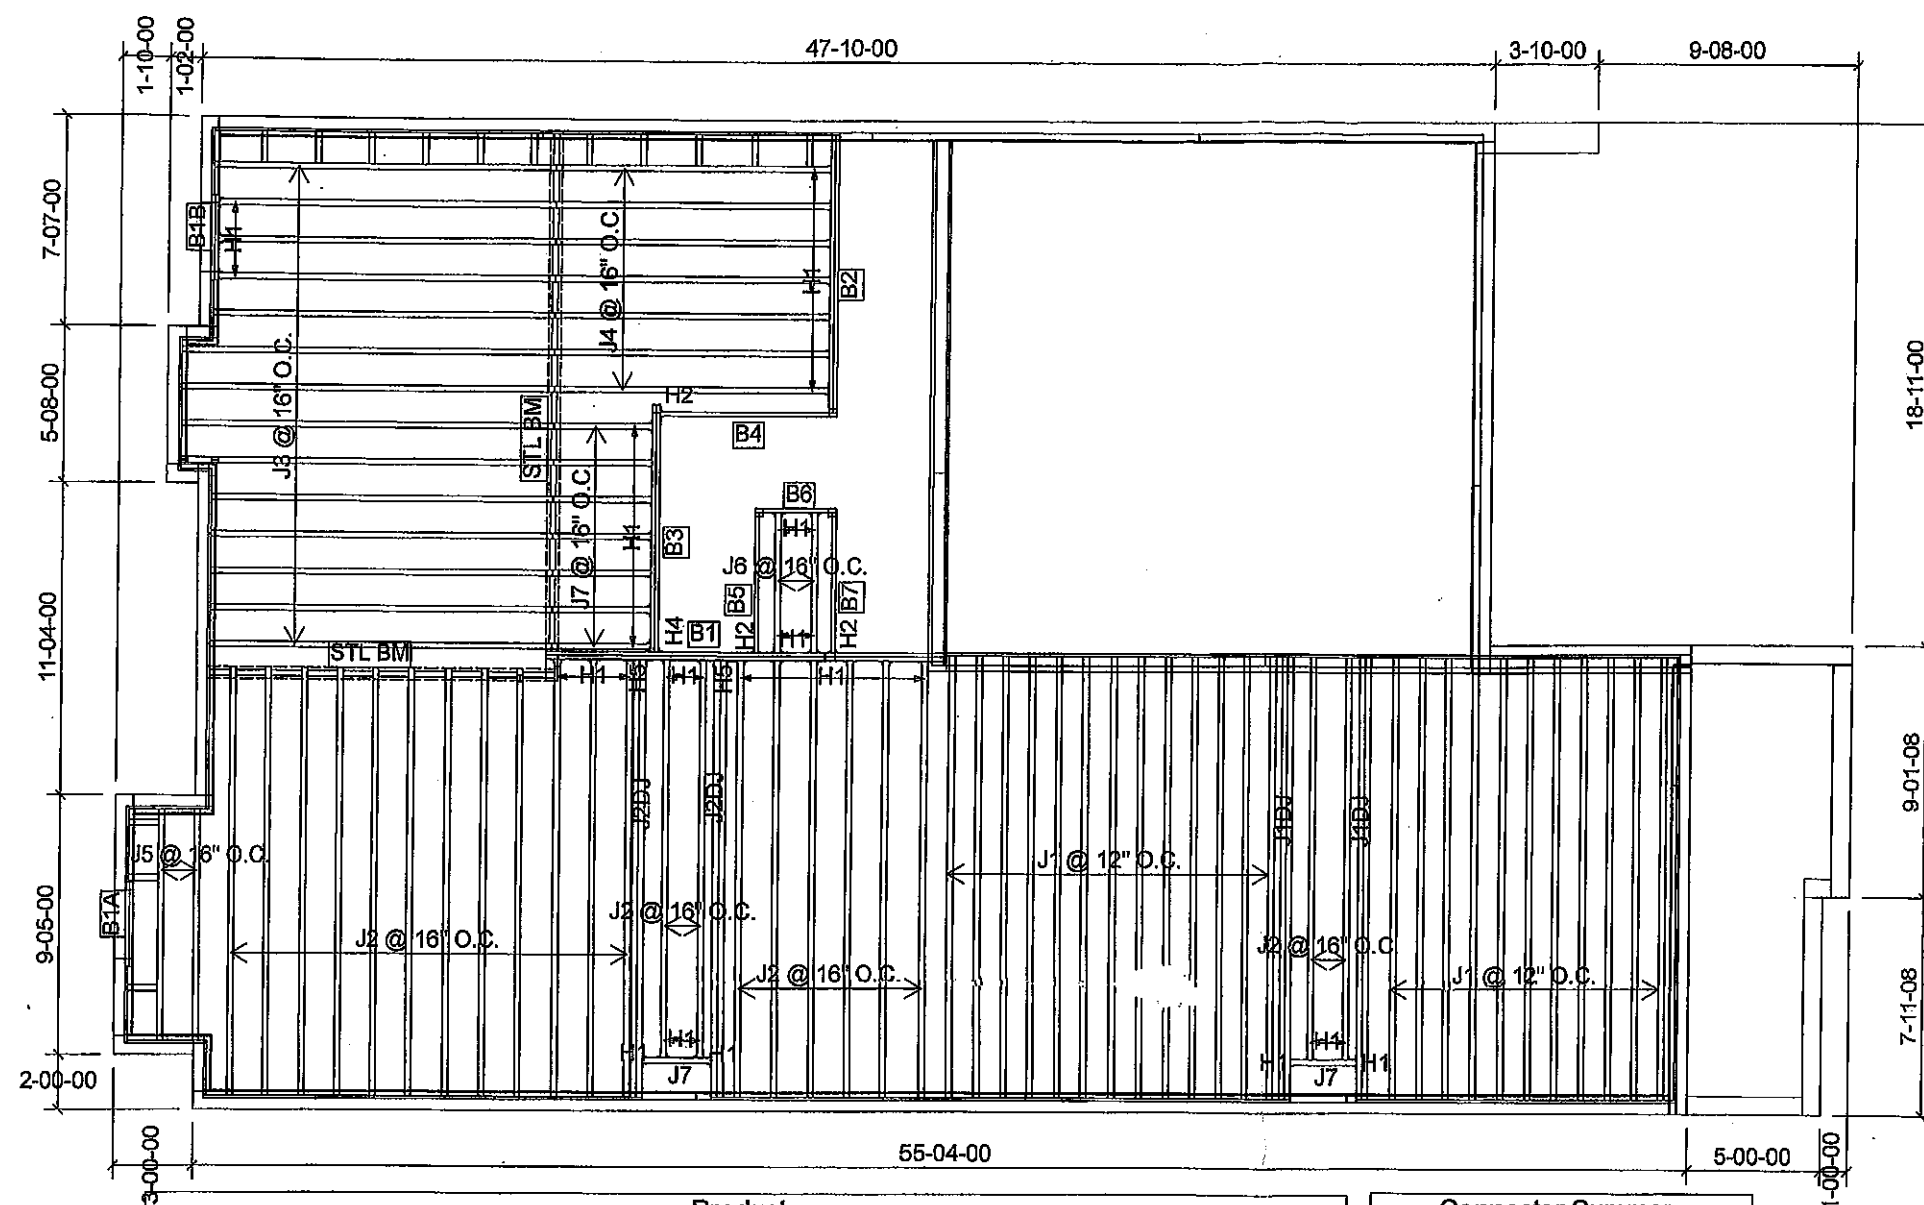

Products					
PlotID	Length	Product	Plies	Net Qty	Fab Type
J1	18-00-00	9 1/2" NI-40x	1	24	MFD
J1DJ	18-00-00	9 1/2" NI-40x	2	4	MFD
J2	16-00-00	9 1/2" NI-40x	1	22	MFD
J2DJ	16-00-00	9 1/2" NI-40x	2	4	MFD
J3	14-00-00	9 1/2" NI-40x	1	14	MFD
J4	12-00-00	9 1/2" NI-40x	1	7	MFD
J5	10-00-00	9 1/2" NI-40x	1	2	MFD
J6	6-00-00	9 1/2" NI-40x	1	2	MFD
J7	4-00-00	9 1/2" NI-40x	1	9	MFD
B1	16-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B2	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B3	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B4	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B5	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B7	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B6	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B1A	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B1B	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD

Connector Summary		
Qty	Manuf	Product
2	H1	IUS2.56/9.5
30	H1	IUS2.56/9.5
4	H1	IUS2.56/9.5
4	H1	IUS2.56/9.5
3	H2	HUS1.81/10
1	H4	HGUS410
2	H5	HU312-2

CITY OF HAMILTON
Building Division

Permit No. 21

107140


THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

FOR CHIEF BUILDING OFFICIAL

APR 28 2021

DATE

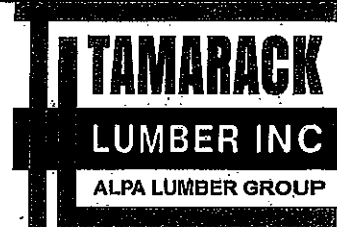

FROM PLAN DATED:

BUILDER: GREEN PARK HOMES

SITE: RUSSELL GARDENS PH 3

MODEL: MOUNTAINASH 6

ELEVATION: 2

LOT:

CITY: WATERDOWN

SALESMAN: MARIO DICIANO

DESIGNER: AJ

REVISION:

NOTES:

REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. **CERAMIC TILE** APPLICATION AS PER O.B.C. 9.30.6

LOADING:

DESIGN LOADS: L/480.000


LIVE LOAD: 40.0 lb/ft²

DEAD LOAD: 20.0 lb/ft²

SUBFLOOR: 5/8" GLUED AND NAILED

DATE: 2020-02-10


2nd FLOOR

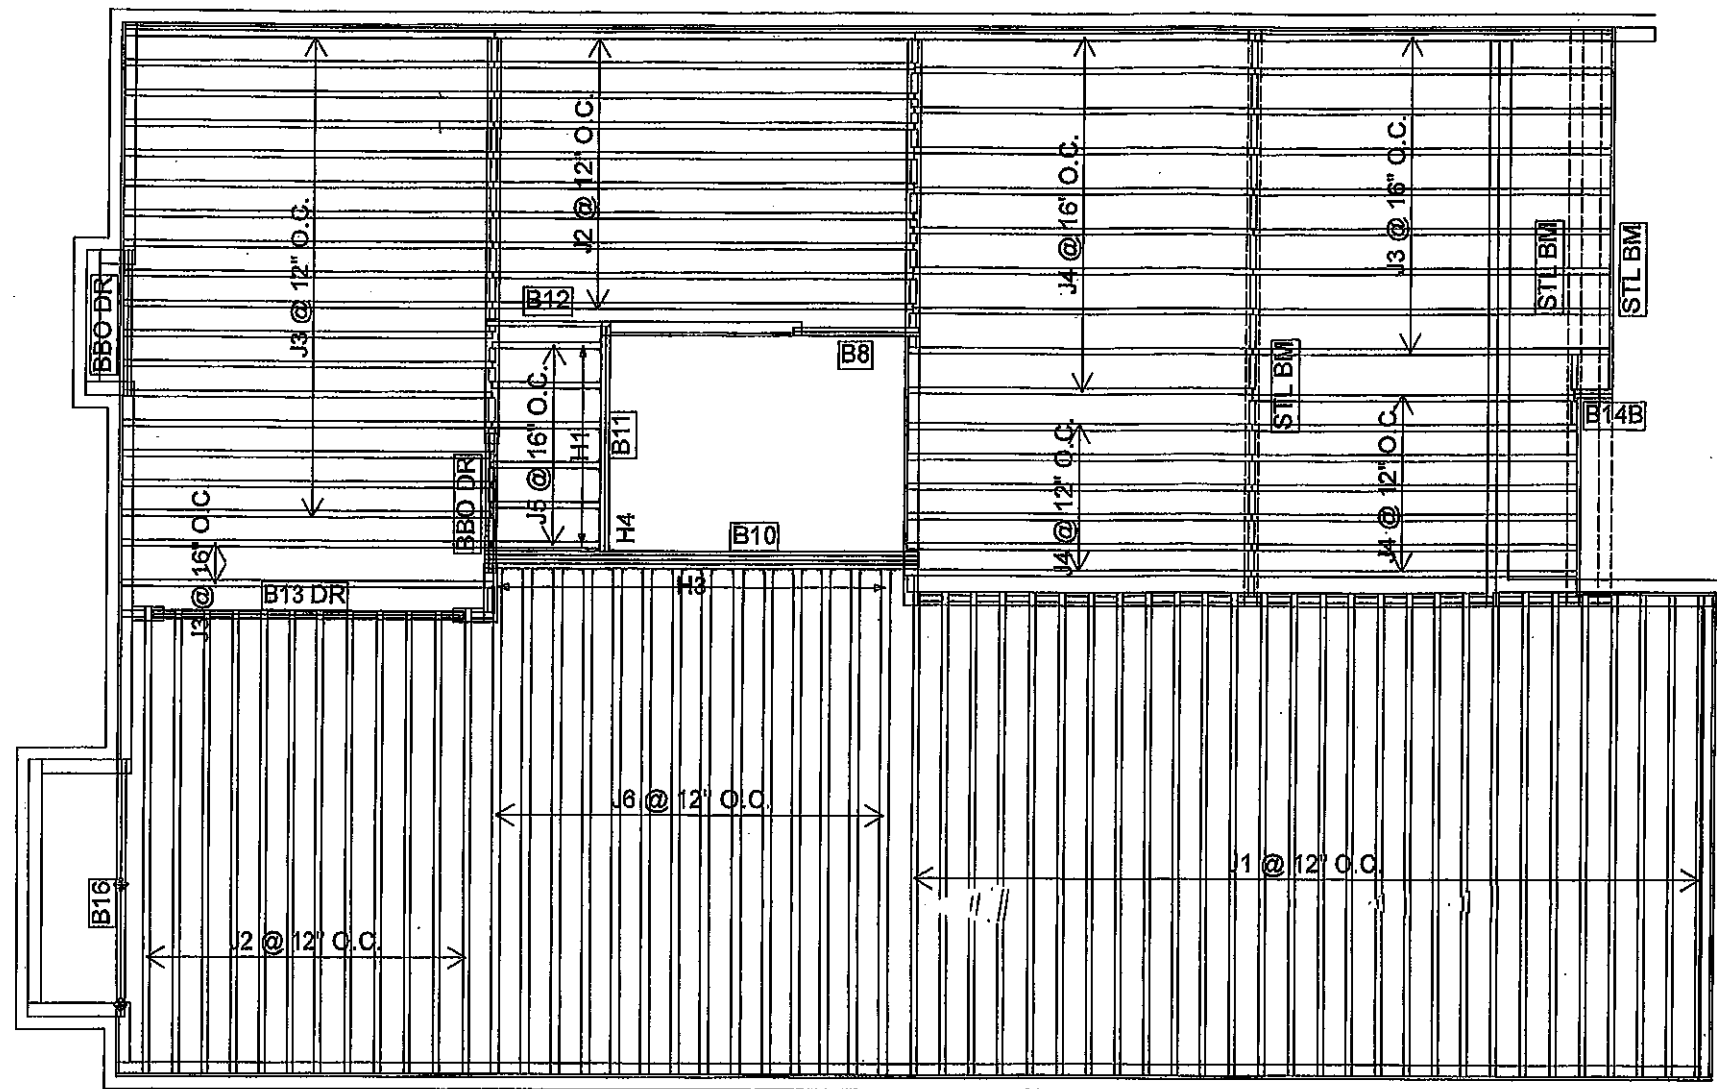


Products					
PlotID	Length	Product	Plies	Net Qty	Fab Type
J1	18-00-00	9 1/2" NI-40x	1	28	MFD
J2	16-00-00	9 1/2" NI-40x	1	22	MFD
J3	14-00-00	9 1/2" NI-40x	1	28	MFD
J4	12-00-00	9 1/2" NI-40x	1	23	MFD
J5	4-00-00	9 1/2" NI-40x	1	6	MFD
J6	18-00-00	9 1/2" NI-80	1	14	MFD
B10	16-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	4	4	MFD
B13 DR	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B16	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B11	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B12	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B8	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B14B	2-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD

Connector Summary		
Qty	Manuf	Product
6	H1	IUS2.56/9.5
14	H3	IUS3.56/9.5
1	H4	HGUS410


CANTILEVER DETAILS FOR BALCONIES (NO WALL LOAD)

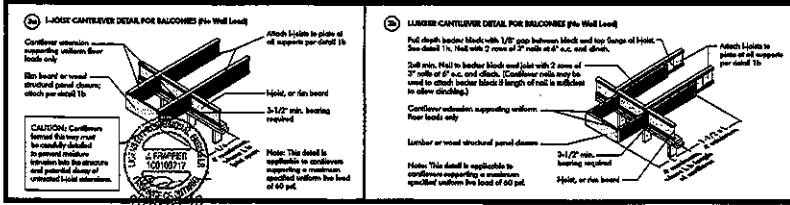

CANTILEVER DETAILS FOR VERTICAL BUILDING OFFSET (CONCENTRATED WALL LOAD)

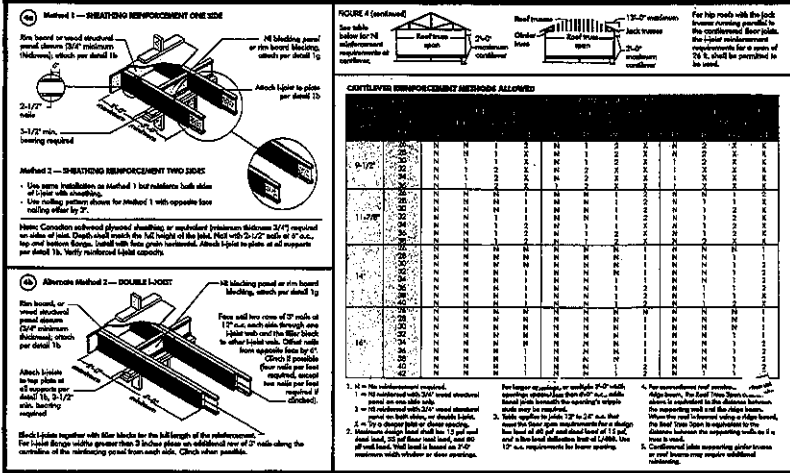

BRICK CANTILEVER DETAILS FOR VERTICAL BUILDING OFFSET (CONCENTRATED WALL LOAD)

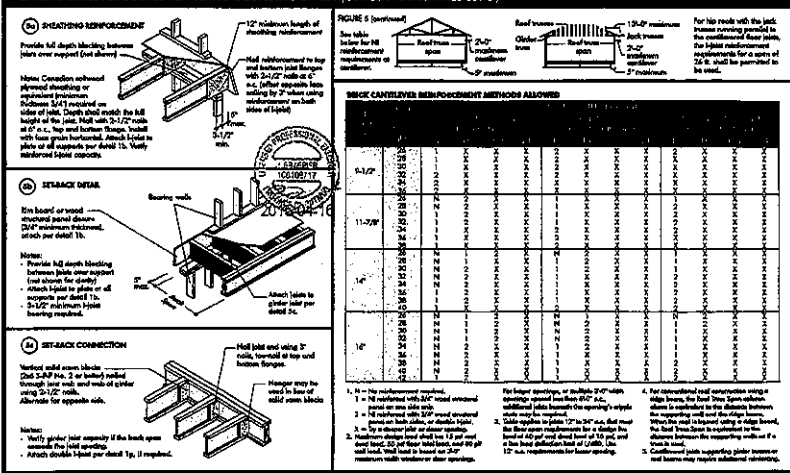

WEB HOLES

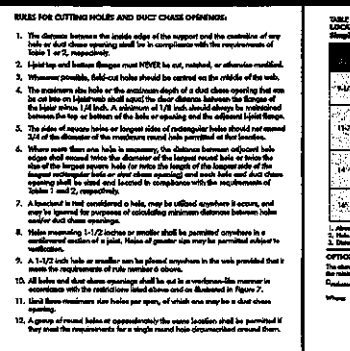


TABLE 1
LOCATION OF CIRCULAR HOLES IN JOIST WEBS
Simple or Multiple Span for Joist Length up to 12 ft and Joist Depth up to 60 ft

Joist Depth (in)	Joist Length (ft)	12	14	16	18	20	22	24	26	28	30	32	34	36	38	40	42	44	46	48	50	52	54	56	58	60
12	12	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
14	14	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
16	16	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
18	18	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
20	20	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
22	22	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
24	24	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
26	26	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
28	28	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
30	30	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
32	32	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
34	34	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
36	36	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
38	38	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
40	40	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
42	42	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
44	44	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
46	46	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
48	48	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
50	50	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
52	52	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
54	54	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
56	56	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
58	58	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
60	60	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1


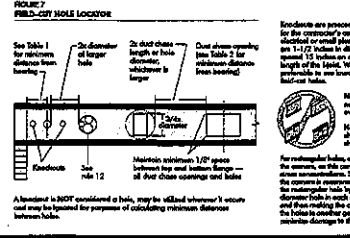



TABLE 2
DISTANCE BETWEEN HOLES AND LOCATIONS - Simple Span Only

Joist Depth (in)	Joist Length (ft)	12	14	16	18	20	22	24	26	28	30	32	34	36	38	40	42	44	46	48	50	52	54	56	58	60
12	12	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
14	14	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
16	16	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
18	18	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
20	20	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
22	22	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
24	24	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
26	26	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
28	28	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
30	30	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
32	32	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
34	34	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
36	36	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
38	38	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
40	40	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
42	42	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
44	44	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
46	46	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
48	48	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
50	50	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
52	52	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
54	54	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
56	56	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
58	58	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
60	60	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1

INSTALLING THE GULF FLOOR SYSTEM

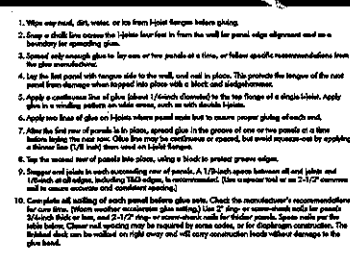

RIM BOARD INSTALLATION DETAILS

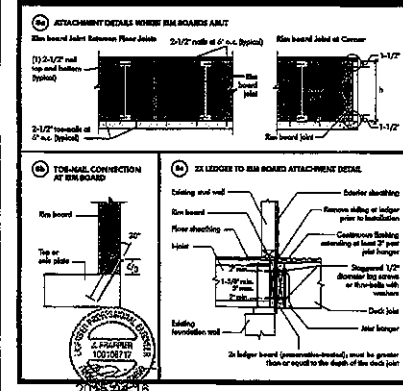

CONSTRUCTION DETAILS FOR RESIDENTIAL FLOORS



Refer to the Installation Guide for Residential Floors for additional information.
ICC Evaluator Report E-13002-E

WEB HOLE SPECIFICATIONS

RULES FOR CUTTING HOLES AND DUCT CHASE OPENINGS:

- The distance between the inside edge of the support and the centerline of any hole or duct chase opening shall be in compliance with the requirements of Table 1 or 2, respectively.
- 1/2" top and bottom flanges must NEVER be cut, notched, or otherwise modified.
- Whenever possible, hole-cut holes should be centered on the middle of the web.
- The minimum size hole or the maximum depth of a duct chase opening that can be cut into an I-beam web shall equal the clear distance between the flanges of the I-beam minus 1/4". A minimum of 1/8" inch should always be maintained between the top or bottom of the hole or opening and the adjacent I-beam flange.

- The size of square holes or longest sides of rectangular holes shall not exceed 2/4" of the diameter of the maximum round hole permitted at that location.
- Where more than one hole is necessary, the distance between adjacent hole edges shall equal or exceed the diameter of the largest round hole or twice the size of the largest square hole (whichever is larger).
- A knockout is not considered a hole, may be utilized anywhere it occurs, and may be ignored for purposes of calculating minimum distances between holes and/or duct chase openings.
- Holes measuring 1/2" inches or smaller are permitted anywhere in a conditioned section of joist. Holes of greater size may be permitted subject to verification.


- A 1-1/2" inch hole or smaller can be placed anywhere in the web provided that it meets the requirements of rule number 4 above.
- All holes and duct chase openings shall be cut in a uniform manner in cross-section with the restrictions listed above, and as illustrated in Figure 7.
1. All three minimum size holes per joist, of which one may be a duct chase opening.
2. A group of round holes of approximately the same location shall be permitted if they meet the requirements for a single round hole disconnected around them.

TABLE 1
LOCATION OF CIRCULAR HOLES IN JOIST WEBS
Simple or Multiple Span for Dead Loads up to 15 psf and Live Loads up to 40 psf

Minimum Distance from Inside Face of Any Support to Center of Hole (in.)																
Joist Depth	Joist Series	Round Hole Diameter (in.)														
		2	3	4	5	6	6-1/4	7	8	8-5/8	9	10	10-3/4	11	12	12-3/4
9-1/2"	NB-20	2-1/2"	3-1/2"	4-1/2"	5-1/2"	6-1/2"	7-1/2"	8-1/2"	9-1/2"	10-1/2"	11-1/2"	12-1/2"	13-1/2"			
	NB-22	2-1/2"	3-1/2"	4-1/2"	5-1/2"	6-1/2"	7-1/2"	8-1/2"	9-1/2"	10-1/2"	11-1/2"	12-1/2"	13-1/2"			
	NB-24	2-1/2"	3-1/2"	4-1/2"	5-1/2"	6-1/2"	7-1/2"	8-1/2"	9-1/2"	10-1/2"	11-1/2"	12-1/2"	13-1/2"			
	NB-26	2-1/2"	3-1/2"	4-1/2"	5-1/2"	6-1/2"	7-1/2"	8-1/2"	9-1/2"	10-1/2"	11-1/2"	12-1/2"	13-1/2"			
11-7/8"	NB-28	2-1/2"	3-1/2"	4-1/2"	5-1/2"	6-1/2"	7-1/2"	8-1/2"	9-1/2"	10-1/2"	11-1/2"	12-1/2"	13-1/2"			
	NB-30	2-1/2"	3-1/2"	4-1/2"	5-1/2"	6-1/2"	7-1/2"	8-1/2"	9-1/2"	10-1/2"	11-1/2"	12-1/2"	13-1/2"			
	NB-32	2-1/2"	3-1/2"	4-1/2"	5-1/2"	6-1/2"	7-1/2"	8-1/2"	9-1/2"	10-1/2"	11-1/2"	12-1/2"	13-1/2"			
	NB-34	2-1/2"	3-1/2"	4-1/2"	5-1/2"	6-1/2"	7-1/2"	8-1/2"	9-1/2"	10-1/2"	11-1/2"	12-1/2"	13-1/2"			
14"	NB-36	2-1/2"	3-1/2"	4-1/2"	5-1/2"	6-1/2"	7-1/2"	8-1/2"	9-1/2"	10-1/2"	11-1/2"	12-1/2"	13-1/2"			
	NB-38	2-1/2"	3-1/2"	4-1/2"	5-1/2"	6-1/2"	7-1/2"	8-1/2"	9-1/2"	10-1/2"	11-1/2"	12-1/2"	13-1/2"			
	NB-40	2-1/2"	3-1/2"	4-1/2"	5-1/2"	6-1/2"	7-1/2"	8-1/2"	9-1/2"	10-1/2"	11-1/2"	12-1/2"	13-1/2"			
	NB-42	2-1/2"	3-1/2"	4-1/2"	5-1/2"	6-1/2"	7-1/2"	8-1/2"	9-1/2"	10-1/2"	11-1/2"	12-1/2"	13-1/2"			
16"	NB-44	2-1/2"	3-1/2"	4-1/2"	5-1/2"	6-1/2"	7-1/2"	8-1/2"	9-1/2"	10-1/2"	11-1/2"	12-1/2"	13-1/2"			
	NB-46	2-1/2"	3-1/2"	4-1/2"	5-1/2"	6-1/2"	7-1/2"	8-1/2"	9-1/2"	10-1/2"	11-1/2"	12-1/2"	13-1/2"			
	NB-48	2-1/2"	3-1/2"	4-1/2"	5-1/2"	6-1/2"	7-1/2"	8-1/2"	9-1/2"	10-1/2"	11-1/2"	12-1/2"	13-1/2"			
	NB-50	2-1/2"	3-1/2"	4-1/2"	5-1/2"	6-1/2"	7-1/2"	8-1/2"	9-1/2"	10-1/2"	11-1/2"	12-1/2"	13-1/2"			

- Always holes may be used for I-beam spacing of 24 inches on center or less.
- Hole location distances are measured from inside face of supports to center of hole.
- Distances in this chart are based on uniformly loaded joists.
- The above hole is based on the I-beam being used at its maximum spans. The minimum distance as given above may be reduced for shorter spans contact your local distributor.

FIGURE 7
FIELD-CUT HOLE LOCATOR

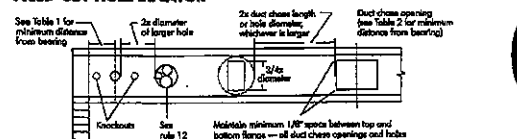

SAFETY AND CONSTRUCTION PRECAUTIONS

- WARNING:** I-beams are not made and completely installed, and will not carry any load until fully braced and shored.
- AVOID ACCIDENTS BY FOLLOWING THESE IMPORTANT GUIDELINES:**
- Beams and joists shall be installed using bracing, blocking, pins, and/or cross-bracing at joist ends. When I-beams are applied continuous over interior supports and a load-bearing wall is present at that location, blocking will be required at the interior support.
 - When the building is completed, the floor sheathing will provide lateral support for the top flanges of the I-beam. Until this sheathing is applied, temporary bracing, often called snags, or temporary sheathing must be applied to prevent I-beam rollover or bowing.
 - Temporary bracing or snags must be 1x4 inch minimum, at least 8 feet long and spaced no more than 8 feet on center, and must be secured with a minimum of two 2-1/2" nails fastened to the top surface of each joist. Nail the bracing to a solid member of the end of each floor. Lap ends of adjoining bracing over at least two I-beams.
 - Or, sheathing (temporary or permanent) can be nailed to the top flange of the last 4 feet of joists at the end of the top.
 - For concentrated loads, bracing top and bottom flanges and bracing webs with cleave pins, end nails, or cross-bracing.
 - Install and fully nail permanent sheathing to each I-beam before placing loads on the floor system. Then, avoid building materials over beams or walls only.
 - Never install a damaged I-beam.
 - Integrate storage or installation, follow to follow applicable building codes, follow to follow span ratings for Nordic I-beams. Follow to follow applicable building codes, follow to follow span ratings for Nordic I-beams. Follow to follow applicable building codes, follow to follow span ratings for Nordic I-beams.

Knockouts are predrilled holes provided for the contractor's convenience in field locations or small plumbing jobs. They are 1-1/2" inches in diameter, and are spaced 15 inches on center along the length of the I-beam. Where possible, it is preferable to use knockouts instead of field-cut holes.

Holes in webs should be cut with a sharp saw.

For rectangular holes, avoid one-cutting the corners, as this can cause unnecessary stress concentrations. Slightly rounding the corners is recommended. Shoring the rectangular hole by drilling a 1-inch diameter hole in each corner and then nailing the cuts between the holes is another good method to avoid damage to the I-beam.

PRODUCT WARRANTY

Our products are warranted to be free from manufacturing defects in materials and workmanship.

Our products are warranted to be free from manufacturing defects in materials and workmanship.

Our products are warranted to be free from manufacturing defects in materials and workmanship.

Blocking Panel on I-beam Joist

2-1/2" nails

Maximum Fastened Uniform Vertical Load (psf)

3,500

Blocking Panel on I-beam Joist

2-1/2" nails

Maximum Fastened Uniform Vertical Load (psf)

3,500

Blocking Panel on I-beam Joist

2-1/2" nails

Maximum Fastened Uniform Vertical Load (psf)

3,500

Blocking Panel on I-beam Joist

2-1/2" nails

Maximum Fastened Uniform Vertical Load (psf)

3,500

Blocking Panel on I-beam Joist

2-1/2" nails

Maximum Fastened Uniform Vertical Load (psf)

3,500

Blocking Panel on I-beam Joist

2-1/2" nails

Maximum Fastened Uniform Vertical Load (psf)

3,500

Blocking Panel on I-beam Joist

2-1/2" nails

Maximum Fastened Uniform Vertical Load (psf)

3,500

Blocking Panel on I-beam Joist

2-1/2" nails

Maximum Fastened Uniform Vertical Load (psf)

3,500

Blocking Panel on I-beam Joist

2-1/2" nails

Maximum Fastened Uniform Vertical Load (psf)

3,500

Blocking Panel on I-beam Joist

2-1/2" nails

Maximum Fastened Uniform Vertical Load (psf)

3,500



Bolt Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****1ST FLR FRAMING\Flush Beams\B1(11955) (Flush Beam)**

February 10, 2020 11:38:52

BC CALC® Member Report

Build 7239

Job name:

File name: MOUNTAINASH 6 EL 1.mmdl

Address:

Description: 1ST FLR FRAMING\Flush Beams\B1(11955)

City, Province, Postal Code:

Specifier:


Customer:

Designer:

Code reports:

CCMC 12472-R

Company:

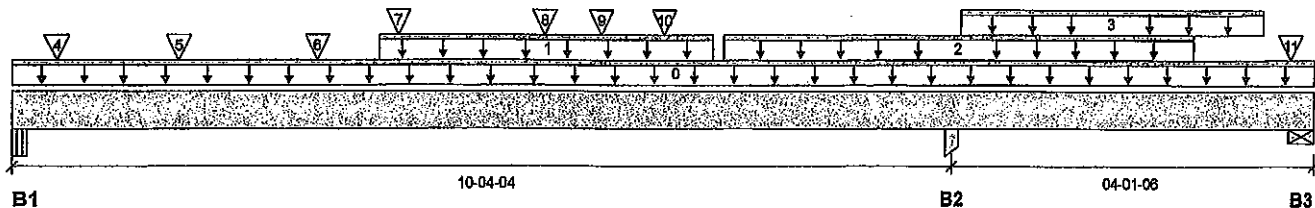

Total Horizontal Product Length = 14-05-10

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-1/4"	3149 / 27	1723 / 0		
B2, 4-1/2"	5407 / 0	2876 / 0		
B3, 5-1/2"	4368 / 1288	3245 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	14-05-10	Top		10			00-00-00
1	STAIR	Unf. Lin. (lb/ft)	L	03-11-10	07-07-10	Top	240	120			n/a
2	Smoothed Load	Unf. Lin. (lb/ft)	L	07-09-02	13-01-02	Top	323	161			n/a
3	STAIR	Unf. Lin. (lb/ft)	L	10-05-06	13-10-10	Top	240	120			n/a
4	J2(12040)	Conc. Pt. (lbs)	L	00-05-02	00-05-02	Top	1454	789			n/a
5	J2(12099)	Conc. Pt. (lbs)	L	01-09-02	01-09-02	Top	431	215			n/a
6	-	Conc. Pt. (lbs)	L	03-03-04	03-03-04	Top	522	261			n/a
7	-	Conc. Pt. (lbs)	L	04-02-02	04-02-02	Top	710	417			n/a
8	J2(12016)	Conc. Pt. (lbs)	L	05-09-02	05-09-02	Top	295	147			n/a
9	J2DJ(12081)	Conc. Pt. (lbs)	L	06-04-10	06-04-10	Top	255	127			n/a
10	J2(11959)	Conc. Pt. (lbs)	L	07-01-02	07-01-02	Top	332	166			n/a
11	-	Conc. Pt. (lbs)	L	14-02-06	14-02-06	Top	3733	3598			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	9867 ft-lbs	23220 ft-lbs	42.5%	2	04-05-02
Neg. Moment	-10975 ft-lbs	-23220 ft-lbs	47.3%	1	10-04-04
End Shear	3496 lbs	11571 lbs	30.2%	2	01-02-12
Cont. Shear	5922 lbs	11571 lbs	51.2%	1	09-04-08
Total Load Deflection	L/584 (0.205")	n/a	41.1%	9	04-11-02
Live Load Deflection	L/886 (0.135")	n/a	40.7%	12	04-11-02
Total Neg. Defl.	L/999 (-0.021")	n/a	n/a	9	11-10-09
Max Defl.	0.205"	n/a	n/a	9	04-11-02
Span / Depth	12.6				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Beam 5-1/4" x 3-1/2"	6878 lbs	70.1%	30.7%	Unspecified
B2	Column 4-1/2" x 3-1/2"	11705 lbs	91.5%	60.9%	Unspecified
B3	Wall/Plate 5-1/2" x 3-1/2"	10607 lbs	89.6%	45.2%	Spruce-Pine-Fir



NO. 6088-20
STRUCTURAL
COMPONENT ONLY



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****1ST FLR FRAMING\Flush Beams\B1(1955) (Flush Beam)**

Dry | 2 spans | No cant.

February 10, 2020 11:38:52

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports: CCMC 12472-R

File name: MOUNTAINASH 6 EL 1.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B1(1955)

Specifier:

Designer:

Company:

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.


Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012**AMENDED 2020**

PROVIDE 2 ROWS OF 3/4" ARDOX
SPIRAL NAILS @ 8" O/C FOR
MULTI-PLY NAILING. MAINTAIN
A MIN. 2" LUMBER EDGE/END
DISTANCE. DO NOT USE AIR NAILS

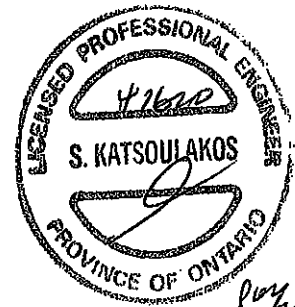

DWG NO. TAM 6008-20
**STRUCTURAL
COMPONENT ONLY**

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****1ST FLR FRAMING\Flush Beams\B1A(I2350) (Flush Beam)**

Dry | 1 span | No cant.

April 16, 2020 08:43:03

BC CALC® Member Report

Build 7239

Job name:

File name: MOUNTAINASH 6 EL 1 DECK CONDITION.mmdl

Address:

Description: 1ST FLR FRAMING\Flush Beams\B1A(I2350)

City, Province, Postal Code: WATERDOWN


Specifier:

Customer:

Designer: AJ

Code reports: CCMC 12472-R

Company:

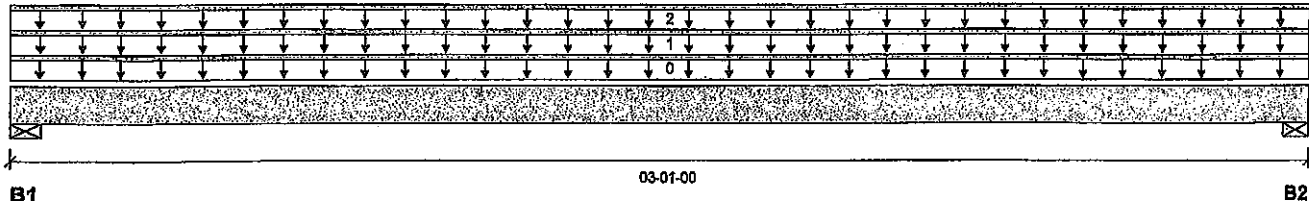

Total Horizontal Product Length = 03-01-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3"	41 / 0	160 / 0		
B2, 3"	41 / 0	160 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	03-01-00	Top	10				00-00-00
1	E3(I585)	Unf. Lin. (lb/ft)	L	00-00-00	03-01-00	Top	81				n/a
2	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	03-01-00	Top	27	13			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	133 ft-lbs	15093 ft-lbs	0.9%	0	01-06-08
End Shear	73 lbs	7521 lbs	1.0%	0	01-00-08
Total Load Deflection	L/999 (0")	n/a	n/a	4	01-06-08
Live Load Deflection	L/999 (0")	n/a	n/a	5	01-06-08
Max Defl.	0"	n/a	n/a	4	01-06-08
Span / Depth	3.4				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 3" x 3-1/2"	224 lbs	5.3%	2.7%	Spruce-Pine-Fir
B2	Wall/Plate 3" x 3-1/2"	224 lbs	5.3%	2.7%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.


Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86. **AMENDED 2020**


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

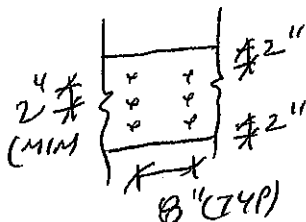CONFORMS TO OBC 2012

PROVIDE 3 ROWS OF 3 1/2" ARDOX SPIRAL NAILS @ 8" O/C FOR MULTI-PLY NAILING. MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS

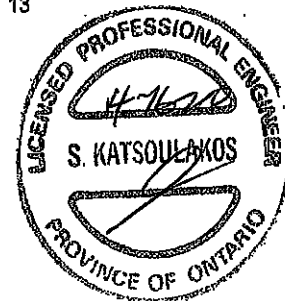

OWB NO. TAM 6096-20
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®.

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****1ST FLR FRAMING\Flush Beams\B1B(i2351) (Flush Beam)**

BC CALC® Member Report

Dry | 1 span | No cant.

April 16, 2020 08:43:03

Build 7239

Job name:

File name: MOUNTAINASH 6 EL 1 DECK CONDITION.mmdl

Address:

Description: 1ST FLR FRAMING\Flush Beams\B1B(i2351)

City, Province, Postal Code: WATERDOWN

Specifier:


Customer:

Designer: AJ

Code reports:

CCMC 12472-R

Company:

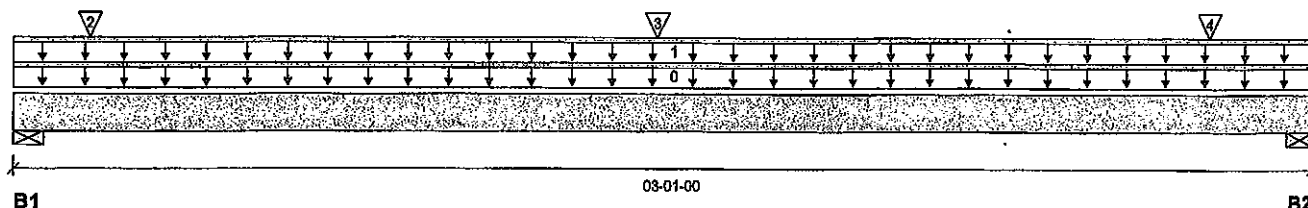

Total Horizontal Product Length = 03-01-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3"	938 / 0	610 / 0		
B2, 3"	928 / 0	604 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	03-01-00	Top	1.00	0.65	1.00	1.15	00-00-00
1	E9(i588)	Unf. Lin. (lb/ft)	L	00-00-00	03-01-00	Top	270	216			n/a
2	J3(i2302)	Conc. Pt. (lbs)	L	00-02-00	00-02-00	Top	345	173			n/a
3	J3(i2284)	Conc. Pt. (lbs)	L	01-06-00	01-06-00	Top	345	173			n/a
4	J3(i2227)	Conc. Pt. (lbs)	L	02-10-00	02-10-00	Top	345	173			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1125 ft-lbs	23220 ft-lbs	4.8%	1	01-06-00
End Shear	721 lbs	11571 lbs	6.2%	1	01-00-08
Total Load Deflection	L/999 (0.002")	n/a	n/a	4	01-06-07
Live Load Deflection	L/999 (0.001")	n/a	n/a	5	01-06-07
Max Defl.	0.002"	n/a	n/a	4	01-06-07
Span / Depth	3.4				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 3" x 3-1/2"	2170 lbs	33.6%	16.9%	Spruce-Pine-Fir
B2	Wall/Plate 3" x 3-1/2"	2147 lbs	33.2%	16.8%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.


Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020

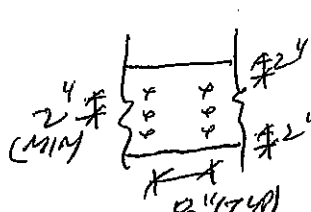

PROVIDE 3 ROWS OF 3 1/2" ARDOX SPIRAL NAILS @ 8" O/C FOR MULTI-PLY NAILING, MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS

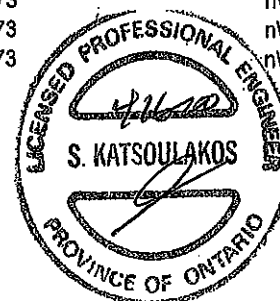

DWG NO. TAM6097-20
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****1ST FLR FRAMING\Flush Beams\B2(i1994) (Flush Beam)**

Dry | 1 span | No cant.

February 10, 2020 11:38:52

BC CALC® Member Report

Build 7239

Job name:

File name: MOUNTAINASH 6 EL 1.mmdl

Address:

Description: 1ST FLR FRAMING\Flush Beams\B2(i1994)

City, Province, Postal Code:

Specifier:


Customer:

Designer:

Code reports:

CCMC 12472-R

Company:

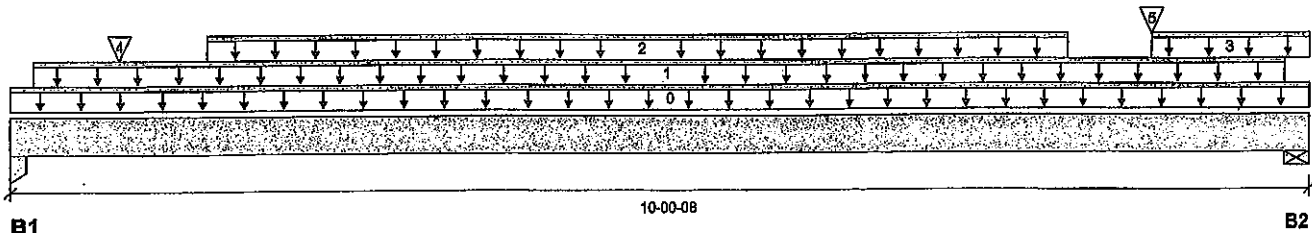

Total Horizontal Product Length = 10-00-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 1-3/4"	985 / 0	834 / 0		
B2, 1-7/8"	942 / 0	810 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	10-00-08	Top	1.00	0.65	1.00	1.15	00-00-00
1	WALL	Unf. Lin. (lb/ft)	L	00-01-12	09-10-02	Top		60			n/a
2	Smoothed Load	Unf. Lin. (lb/ft)	L	01-05-10	08-01-10	Top	210	104			n/a
3	FC1 Floor Material	Unf. Lin. (lb/ft)	L	08-09-10	10-00-08	Top	22				n/a
4	J4(i1985)	Conc. Pt. (lbs)	L	00-09-10	00-09-10	Top	244	122			n/a
5	J4(i1973)	Conc. Pt. (lbs)	L	08-09-10	08-09-10	Top	262	131			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	6498 ft-lbs	23220 ft-lbs	28.0%	1	04-09-10
End Shear	2370 lbs	11571 lbs	20.5%	1	09-01-02
Total Load Deflection	L/728 (0.163")	n/a	33.0%	4	05-00-10
Live Load Deflection	L/999 (0.089")	n/a	n/a	5	05-00-10
Max Defl.	0.163"	n/a	n/a	4	05-00-10
Span / Depth	12.5				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Column 1-3/4" x 3-1/2"	2520 lbs	50.7%	33.7%	Unspecified
B2	Wall/Plate 1-7/8" x 3-1/2"	2426 lbs	60.1%	30.3%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86. **AMENDED 2020**



BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

PROVIDE 3 ROWS OF 3/4" ARDOX SPIRAL NAILS @ 12" O/C FOR MULTI-PLY NAILING. MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS

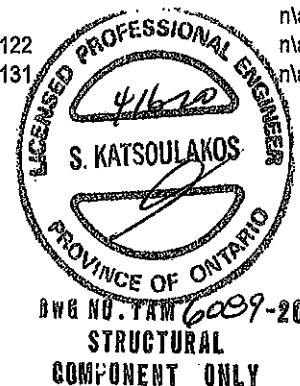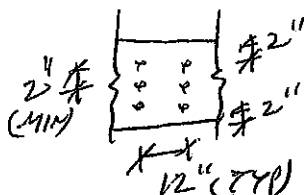**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®.



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****1ST FLR FRAMING\Flush Beams\B3(1931) (Flush Beam)**

Dry | 1 span | No cant.

February 10, 2020 11:38:52

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports: CCMC 12472-R


File name: MOUNTAINASH 6 EL 1.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B3(1931)

Specifier:

Designer:

Company:

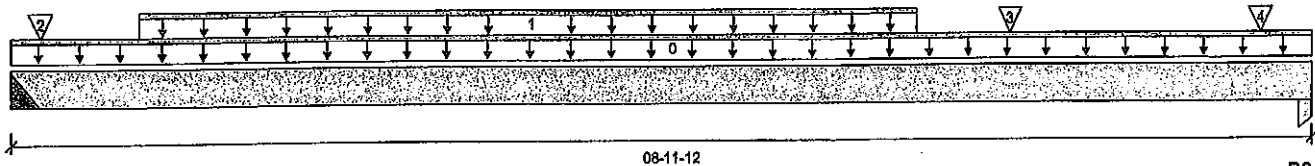**Reaction Summary (Down / Uplift) (lbs)**

Bearing	Live	Dead	Snow	Wind
B1, 2"	358 / 0	222 / 0		
B2, 3-1/2"	810 / 0	999 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	08-11-12	Top	1.00	0.65	1.00	1.15	00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	00-10-04	06-02-04	Top	80	40			n/a
2	J7(I2069)	Conc. Pt. (lbs)	L	00-02-04	00-02-04	Top	67	34			n/a
3	J7(I2079)	Conc. Pt. (lbs)	L	06-10-04	06-10-04	Top	108	54			n/a
4	-	Conc. Pt. (lbs)	L	08-07-07	08-07-07	Top	559	830			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1714 ft-lbs	23220 ft-lbs	7.4%	1	04-02-04
End Shear	706 lbs	11571 lbs	6.1%	1	07-10-12
Total Load Deflection	L/999 (0.032")	n/a	n/a	4	04-04-04
Live Load Deflection	L/999 (0.02")	n/a	n/a	5	04-04-04
Max Defl.	0.032"	n/a	n/a	4	04-04-04
Span / Depth	10.9				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Hanger 2" x 3-1/2"	813 lbs	n/a	9.5%	Hanger
B2	Column 3-1/2" x 3-1/2"	2463 lbs	24.8%	16.5%	Unspecified



OWB NO. YAW 6090-20
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.


BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®.

Cautions

Hanger model Hanger was not found. Hanger has not been analyzed for adequate capacity.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
Design meets Code minimum (L/360) Live load deflection criteria.
Calculations assume unbraced length of Top: 00-00-00, Bottom: 00-00-00. **CONFORMS TO OBC 2012**
Hanger Manufacturer: Unassigned
Resistance Factor phi has been applied to all presented results per CSA O86. **AMENDED 2020**
BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.
Design based on Dry Service Condition.
Importance Factor : Normal Part code : Part 9



PROVIDE 3 ROWS OF 3/4" ARDOX SPIRAL NAILS @ 8" O/C FOR MULTI-PLY NAILING. MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS



Bolse Cascade

**Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****1ST FLR FRAMING\Flush Beams\B4(i2084) (Flush Beam)****PASSED**

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R

Dry | 1 span | No cant.

February 10, 2020 11:38:52


File name: MOUNTAINASH 6 EL 1.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B4(i2084)

Specifier:

Designer:

Company:

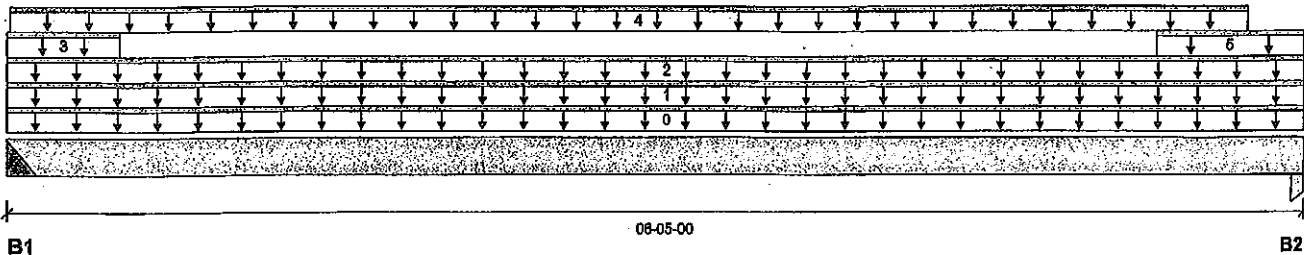**Reaction Summary (Down / Uplift) (lbs)**


Bearing	Live	Dead	Snow	Wind
B1, 2"	344 / 0	618 / 0		
B2, 3-1/2"	167 / 0	496 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	06-05-00	Top		5			00-00-00
1	3(i760)	Unf. Lin. (lb/ft)	L	00-00-00	06-05-00	Top		81			n/a
2	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	06-05-00	Top	19	9			n/a
3	3(i760)	Unf. Lin. (lb/ft)	L	00-00-00	00-06-06	Top	427	536			n/a
4	3(i760)	Unf. Lin. (lb/ft)	L	00-00-02	06-01-08	Top	20	12			n/a
5	3(i760)	Unf. Lin. (lb/ft)	L	05-08-00	06-05-00	Top	53	192			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	748 ft-lbs	7546 ft-lbs	9.9%	0	03-01-12
End Shear	594 lbs	3761 lbs	15.8%	0	00-11-08
Total Load Deflection	L/999 (0.02")	n/a	n/a	4	03-01-12
Live Load Deflection	L/999 (0.006")	n/a	n/a	5	03-00-15
Max Defl.	0.02"	n/a	n/a	4	03-01-12
Span / Depth	7.7				

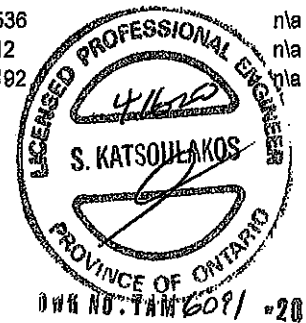**STRUCTURAL COMPONENT ONLY****Disclosure**

Use of the Bolse Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Bolse Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1 Hanger	2" x 1-3/4"	865 lbs	n/a	31.2%	Hanger
B2 Column	3-1/2" x 1-3/4"	694 lbs	21.5%	14.3%	Unspecified

Cautions

Hanger model Hanger was not found. Hanger has not been analyzed for adequate capacity.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012**AMENDED 2020**

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP
1ST FLR FRAMING\Flush Beams\B5(12038) (Flush Beam)

PASSED

BC CALC® Member Report

Dry | 1 span | No cant.

February 10, 2020 11:38:52

Build 7239

Job name:

File name: MOUNTAINASH 6 EL 1.mmdl

Address:

Description: 1ST FLR FRAMING\Flush Beams\B5(12038)

City, Province, Postal Code:

Specifier:


Customer:

Designer:

Code reports:

CCMC 12472-R

Company:

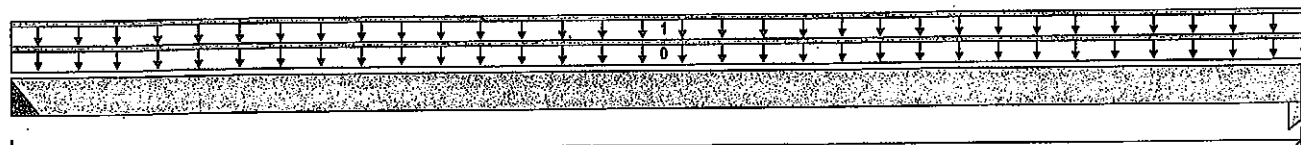

B1

05-01-02

B2

Total Horizontal Product Length = 05-01-02

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 2"	44 / 0	34 / 0		
B2, 1-3/4"	44 / 0	34 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	05-01-02	Top	1.00	0.65	1.00	1.15	00-00-00
1	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	05-01-02	Top	17	9			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	129 ft-lbs	11610 ft-lbs	1.1%	1	02-06-11
End Shear	68 lbs	5785 lbs	1.2%	1	00-11-08
Total Load Deflection	L/999 (0.002")	n/a	n/a	4	02-06-11
Live Load Deflection	L/999 (0.001")	n/a	n/a	5	02-06-11
Max Defl.	0.002"	n/a	n/a	4	02-06-11
Span / Depth	6.2				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Hanger 2" x 1-3/4"	109 lbs	n/a	2.6%	Hanger
B2	Column 1-3/4" x 1-3/4"	108 lbs	4.4%	2.9%	Unspecified



NO. 6092-20
STRUCTURAL
COMPONENT ONLY

Cautions

Hanger model Hanger was not found. Hanger has not been analyzed for adequate capacity.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OHS 2012

AMENDED 2020

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of Input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before Installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCi®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Boise Cascade

**Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****1ST FLR FRAMING\Flush Beams\B6(I2036) (Flush Beam)****PASSED**

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R

Dry | 1 span | No cant.

February 10, 2020 11:38:52


File name: MOUNTAINASH 6 EL 1.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B6(I2036)

Specifier:

Designer:

Company:

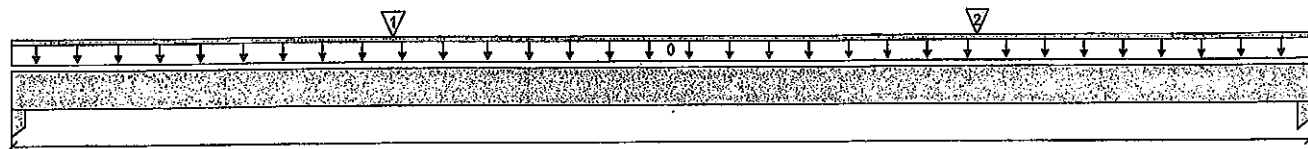

B1

02-11-12

B2

Total Horizontal Product Length = 02-11-12

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3-1/2"	113 / 0	64 / 0		
B2, 3-1/2"	119 / 0	67 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	02-11-12	Top	1.00	0.65	1.00	1.15	00-00-00
1	J6(I1935)	Conc. Pt. (lbs)	L	00-10-06	00-10-06	Top	118	59			n/a
2	J6(I2002)	Conc. Pt. (lbs)	L	02-02-06	02-02-06	Top	114	57			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	157 ft-lbs	11610 ft-lbs	1.3%	1	00-10-11
End Shear	174 lbs	5785 lbs	3.0%	1	01-01-00
Total Load Deflection	L/999 (0.001")	n/a	n/a	4	01-05-14
Live Load Deflection	L/999 (0")	n/a	n/a	5	01-05-14
Max Defl.	0.001"	n/a	n/a	4	01-05-14
Span / Depth	3.2				

Bearing Supports

				Demand/ Resistance Support	Demand/ Resistance Member	Material
Bearing Supports		Dim. (LxW)	Demand			
B1	Column	3-1/2" x 1-3/4"	249 lbs	5.0%	3.3%	Unspecified
B2	Column	3-1/2" x 1-3/4"	261 lbs	5.3%	3.5%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86. **AMENDED 2020**

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



DWG NO. TAM 6093-20
**STRUCTURAL
COMPONENT ONLY**



Boise Cascade

**Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****1ST FLR FRAMING\Flush Beams\B7(12063) (Flush Beam)****PASSED**

BC CALC® Member Report

Dry | 1 span | No cant.

February 10, 2020 11:38:52

Buld 7239

Job name:

File name: MOUNTAINASH 6 EL 1.mmdl

Address:

Description: 1ST FLR FRAMING\Flush Beams\B7(12063)

City, Province, Postal Code:

Specifier:


Customer:

Designer:

Code reports:

CCMC 12472-R

Company:



B1

05-01-02

B2

Total Horizontal Product Length = 05-01-02

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 2"	40 / 0	32 / 0		
B2, 1-3/4"	40 / 0	32 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	05-01-02	Top	1.00	0.65	1.00	1.15	00-00-00
1	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	05-01-02	Top	16	8			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	118 ft-lbs	11610 ft-lbs	1.0%	1	02-06-11
End Shear	63 lbs	5785 lbs	1.1%	1	00-11-08
Total Load Deflection	L/999 (0.001")	n/a	n/a	4	02-06-11
Live Load Deflection	L/999 (0.001")	n/a	n/a	5	02-06-11
Max Defl.	0.001"	n/a	n/a	4	02-06-11
Span / Depth	6.2				

Bearing Supports

				Demand/ Resistance Support	Demand/ Resistance Member	Material
Bearing Supports		Dim. (LxW)	Demand			
B1	Hanger	2" x 1-3/4"	100 lbs	n/a	2.3%	Hanger
B2	Column	1-3/4" x 1-3/4"	99 lbs	4.0%	2.7%	Unspecified

Cautions

Hanger model Hanger was not found. Hanger has not been analyzed for adequate capacity.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020



UWG NO. TAM 6094 -20

**STRUCTURAL
COMPONENT ONLY****Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA).

Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods.

Installation of Boise Cascade engineered wood products must be in accordance with current installation Guide and applicable building codes. To obtain installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Flush Beams\B8\I2152\ (Flush Beam)**

Dry | 1 span | No cant.

February 10, 2020 11:38:52

BC CALC® Member Report

Build 7239

Job name:

File name: MOUNTAINASH 6 EL 1.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B8\I2152\

City, Province, Postal Code:

Specifier:


Customer:

Designer:

Code reports:

CCMC 12472-R

Company:

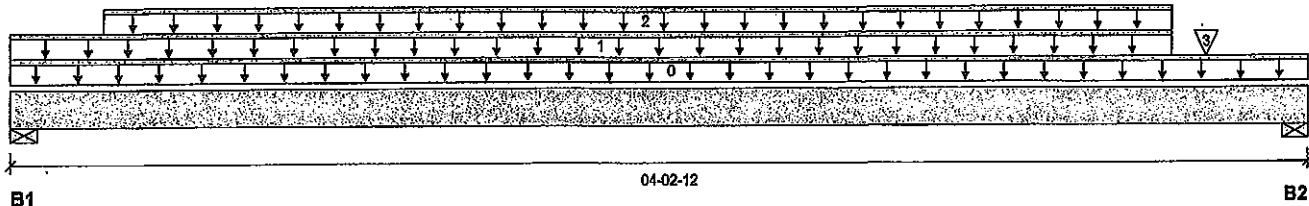

Total Horizontal Product Length = 04-02-12

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3-1/2"	41 / 0	144 / 0		
B2, 5-1/2"	36 / 0	143 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	04-02-12	Top		10			00-00-00
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	03-09-04	Top	20	10			n/a
2	WALL	Unf. Lin. (lb/ft)	L	00-03-08	03-09-04	Top		60			n/a
3	FC2 Floor Material	Conc. Pt. (lbs)	L	03-10-10	03-10-10	Top	1				n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	181 ft-lbs	15093 ft-lbs	1.2%	0	02-00-06
End Shear	106 lbs	7521 lbs	1.4%	0	01-01-00
Total Load Deflection	L/999 (0.001")	n/a	n/a	4	02-00-06
Live Load Deflection	L/999 (0")	n/a	n/a	5	02-00-06
Max Defl.	0.001"	n/a	n/a	4	02-00-06
Span / Depth	4.6				



ENG NO. YAW 6087-20
**STRUCTURAL
 COMPONENT ONLY**

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 3-1/2" x 3-1/2"	202 lbs	4.1%	2.1%	Spruce-Pine-Fir
B2	Wall/Plate 5-1/2" x 3-1/2"	201 lbs	2.6%	1.3%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020

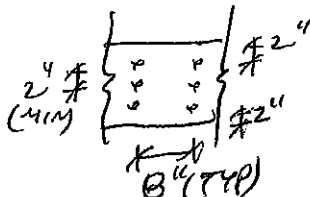

PROVIDE 3 ROWS OF 3/4" ARDOX
 SPIRAL NAILS @ 8" O/C FOR
 MULTI-PLY NAILING. MAINTAIN
 A MIN. 2" LUMBER EDGE/END
 DISTANCE. DO NOT USE AIR NAILS

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA).

Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJST™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®.



Boise Cascade

**Quadruple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****2ND FLR FRAMING\Flush Beams\B10(i2111) (Flush Beam)****PASSED**

BC CALC® Member Report

Dry | 1 span | No cant.

February 10, 2020 11:38:52

Build 7239

Job name:

File name: MOUNTAINASH 6 EL 1.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B10(i2111)

City, Province, Postal Code:

Specifier:


Customer:

Designer:

Code reports:

CCMC 12472-R

Company:

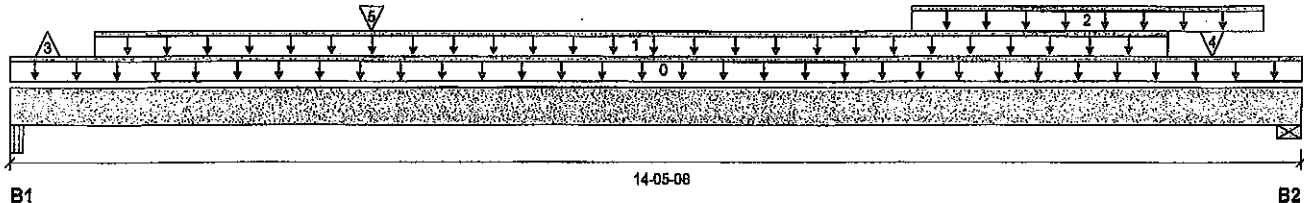

Total Horizontal Product Length = 14-05-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 4-1/2"	2574 / 597	1313 / 0		
B2, 5-1/2"	2883 / 0	1649 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	14-05-08	Top	1.00	0.65	1.00	1.15	00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	00-11-00	12-11-00	Top	353	176			n/a
2	STAIR	Unf. Lin. (lb/ft)	L	10-00-00	14-00-00	Top	120	60			n/a
3	J6(i1586)	Conc. Pt. (lbs)	L	00-05-00	00-05-00	Top	-597	-282			n/a
4	J6(i2121)	Conc. Pt. (lbs)	L	13-05-00	13-05-00	Top	338	169			n/a
5	B11(i2153)	Conc. Pt. (lbs)	L	03-11-10	03-11-10	Top	305	406			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	21228 ft-lbs	48297 ft-lbs	44.0%	1	07-05-00
End Shear	5935 lbs	23142 lbs	25.8%	1	13-02-08
Total Load Deflection	L/317 (0.52")	n/a	75.6%	6	07-02-00
Live Load Deflection	L/508 (0.325")	n/a	70.9%	8	07-02-00
Max Defl.	0.52"	n/a	n/a	6	07-02-00
Span / Depth	17.4				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Beam 4-1/2" x 7"	5502 lbs	28.4%	14.3%	Spruce-Pine-Fir
B2	Wall/Plate 5-1/2" x 7"	6387 lbs	27.0%	13.6%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.


Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86. **AMENDED 2020**

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

BOLT MULTI-PLY MEMBERS USING
2 ROWS 1/2" Ø A307 BOLTS
C/W WASHERS/NUTS @ 16" O.C.



DWG NO. TAM 6082-20

STRUCTURAL**COMPONENT ONLY****Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCi®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****2ND FLR FRAMING\Flush Beams\B11(I2153) (Flush Beam)****PASSED**

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R

Dry | 1 span | No cant.

February 10, 2020 11:38:52


File name: MOUNTAINASH 6 EL 1.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B11(I2153)

Specifier:

Designer:

Company:

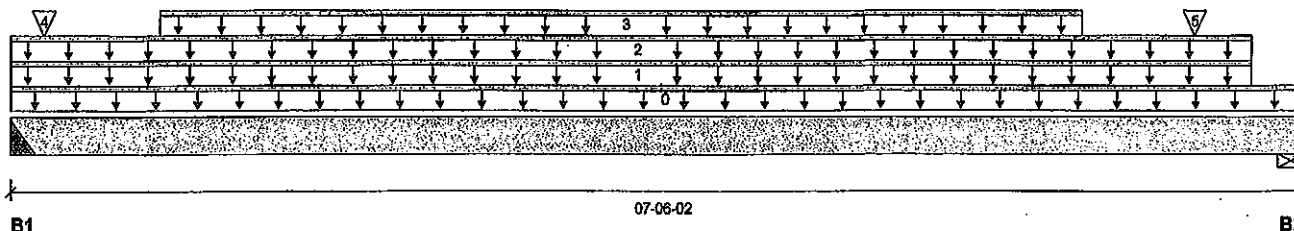

Total Horizontal Product Length = 07-06-02

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 2"	307 / 0	409 / 0		
B2, 3-3/4"	290 / 0	393 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	07-06-02	Top		10			00-00-00
1	WALL	Unf. Lin. (lb/ft)	L	00-00-00	07-02-06	Top		60			n/a
2	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	07-02-06	Top	6	3			n/a
3	Smoothed Load	Unf. Lin. (lb/ft)	L	00-10-06	06-02-06	Top	76	38			n/a
4	J5(I1619)	Conc. Pt. (lbs)	L	00-02-06	00-02-06	Top	70	35			n/a
5	J5(I1506)	Conc. Pt. (lbs)	L	06-10-06	06-10-06	Top	77	39			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/ Resistance	Case	Location
Pos. Moment	1645 ft-lbs	23220 ft-lbs	7.1%	1	03-11-06
End Shear	744 lbs	11571 lbs	6.4%	1	06-04-14
Total Load Deflection	L/999 (0.022")	n/a	n/a	4	03-08-06
Live Load Deflection	L/999 (0.009")	n/a	n/a	5	03-08-06
Max Defl.	0.022"	n/a	n/a	4	03-08-06
Span / Depth	9.0				

Bearing Supports

	Dim. (LxW)	Demand	Demand/ Resistance Support	Demand/ Resistance Member	Material
B1	Hanger 2" x 3-1/2"	972 lbs	n/a	11.4%	Hanger
B2	Wall/Plate 3-3/4" x 3-1/2"	926 lbs	11.5%	5.8%	Spruce-Pine-Fir

Cautions

Hanger model Hanger was not found. Hanger has not been analyzed for adequate capacity.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.



BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012**AMENDED 2020**

PROVIDE 3 ROWS OF 3/4" ARDOX
SPIRAL NAILS @ 12" O/C FOR
MULTI-PLY NAILING. MAINTAIN
A MIN. 2" LUMBER EDGE/END
DISTANCE. DO NOT USE AIR NAILS

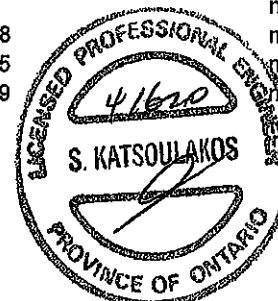

DWG NO. YAM 6083-20

**STRUCTURAL
COMPONENT ONLY****Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®.



Boise Cascade



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

2ND FLR FRAMING\Flush Beams\B12(i1651) (Flush Beam)

PASSED

BC CALC® Member Report
Build 7239

Dry | 1 span | No cant.

February 10, 2020 11:38:52

Job name:

File name: MOUNTAINASH 6 EL 1.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B12(i1651)

City, Province, Postal Code:

Specifier:


Customer:

Designer:

Code reports:

CCMC 12472-R

Company:

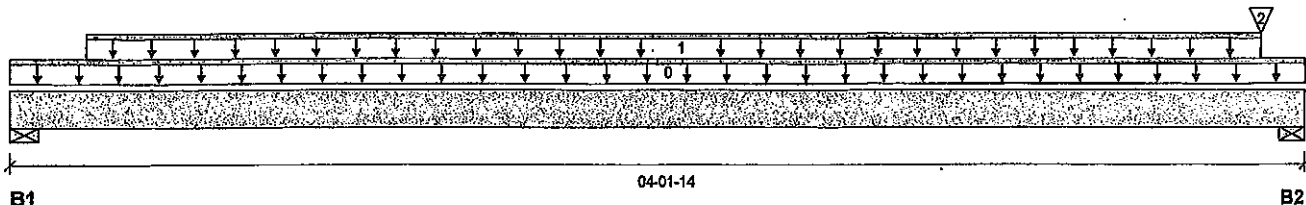

Total Horizontal Product Length = 04-01-14

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-1/2"	52 / 0	36 / 0		
B2, 3-1/2"	51 / 0	35 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	04-01-14	Top	1.00	0.65	1.00	1.15	00-00-00
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-02-12	04-00-02	Top	27	13			n/a
2	FC2 Floor Material	Conc. Pt. (lbs)	L	04-00-02	04-00-02	Top	2	1			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	98 ft-lbs	11610 ft-lbs	0.8%	1	02-01-15
End Shear	57 lbs	5785 lbs	1.0%	1	01-03-00
Total Load Deflection	L/999 (0.001")	n/a	n/a	4	02-01-15
Live Load Deflection	L/999 (0")	n/a	n/a	5	02-01-15
Max Defl.	0.001"	n/a	n/a	4	02-01-15
Span / Depth	4.5				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 5-1/2" x 1-3/4"	123 lbs	2.1%	1.0%	Spruce-Pine-Fir
B2	Wall/Plate 3-1/2" x 1-3/4"	121 lbs	3.2%	1.6%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020

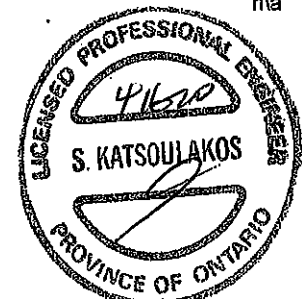

DWG NO. TAM 6084-20
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®



Boise Cascade



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

2ND FLR FRAMING\Dropped Beams\B13 DR(i1726) (Dropped Beam)

PASSED

BC CALC® Member Report

Dry | 1 span | No cant.

February 10, 2020 11:38:52

Build 7239

Job name:

File name: MOUNTAINASH 6 EL 1.mmdl

Address:

Description: 2ND FLR FRAMING\Dropped Beams\B13 DR(i1726)

City, Province, Postal Code:

Specifier:


Customer:

Designer:

Code reports:

CCMC 12472-R

Company:

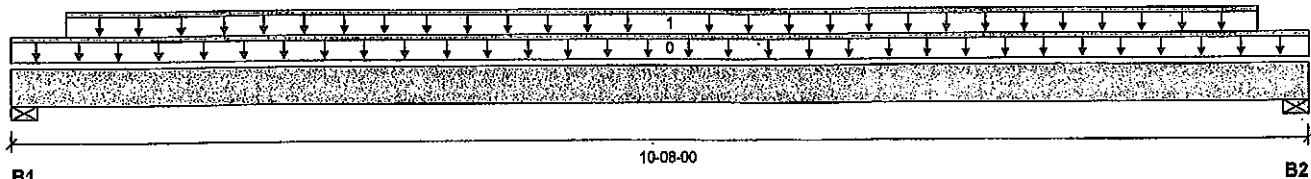

Total Horizontal Product Length = 10-08-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 4"	1619 / 0	861 / 0		
B2, 4"	1618 / 0	861 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	10-08-00	Top	1.00	0.65	1.00	1.15	00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	00-05-04	10-02-12	Top	313	156			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	8926 ft-lbs	23220 ft-lbs	38.4%	1	05-08-12
End Shear	3236 lbs	11571 lbs	28.0%	1	01-01-08
Total Load Deflection	L/523 (0.232")	n/a	45.9%	4	04-11-04
Live Load Deflection	L/800 (0.152")	n/a	45.0%	5	04-11-04
Max Defl.	0.232"	n/a	n/a	4	04-11-04
Span / Depth	12.8				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 4" x 3-1/2"	3504 lbs	18.8%	20.5%	Spruce-Pine-Fir
B2	Wall/Plate 4" x 3-1/2"	3503 lbs	18.8%	20.5%	Spruce-Pine-Fir



OWN NO. TAM6001-20
STRUCTURAL
COMPONENT ONLY

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.


Calculations assume unbraced length of Top: 00-02-08, Bottom: 00-02-08.

Resistance Factor phi has been applied to all presented results per CSA O86. **AMENDED 2020**

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

PROVIDE 3 ROWS OF 3/4" ARDOX
SPIRAL NAILS @ 12" O/C FOR
MULTI-PLY NAILING, MAINTAIN
A MIN. 2" LUMBER EDGE/END
DISTANCE. DO NOT USE AIR NAILS

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****2ND FLR FRAMING\Flush Beams\B14(I2151) (Flush Beam)****PASSED**

BC CALC® Member Report

Dry | 1 span | No cant.

February 10, 2020 11:38:52

Build 7239

Job name:

File name: MOUNTAINASH 6 EL 1.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B14(I2151)

City, Province, Postal Code:

Specifier:


Customer:

Designer:

Code reports:

CCMC 12472-R

Company:

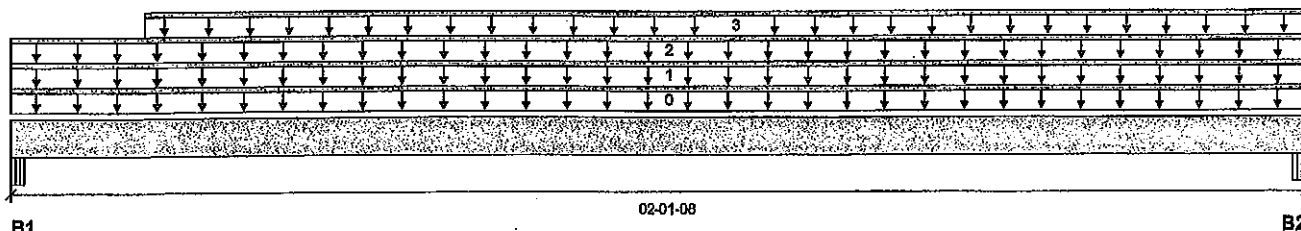

B1

Total Horizontal Product Length = 02-01-08

B2

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 2-5/8"	43 / 0	120 / 0	42 / 0	
B2, 4-1/8"	55 / 0	138 / 0	47 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	02-01-08	Top	1.00	10			00-00-00
1	SNOW	Unf. Lin. (lb/ft)	L	00-00-00	02-01-08	Top	22	20	42		n/a
2	WALL	Unf. Lin. (lb/ft)	L	00-00-00	02-01-08	Top		80			n/a
3	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-02-10	02-01-08	Top	27	13			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	96 ft-lbs	23220 ft-lbs	0.4%	1	01-00-02
End Shear	2 lbs	7521 lbs	n/a	0	01-00-02
Total Load Deflection	L/999 (0")	n/a	n/a	35	01-00-02
Max Defl.	0"	n/a	n/a	35	01-00-02
Span / Depth	2.1				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1 Beam	2-5/8" x 3-1/2"	168 lbs	5.3%	2.3%	Unspecified
B2 Beam	4-1/8" x 3-1/2"	302 lbs	3.9%	1.7%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Calculations assume member is fully braced.


Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.


Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

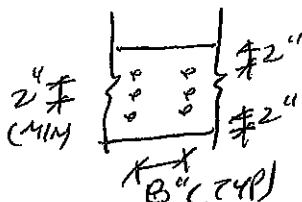CONFORMS TO OBC 2012**AMENDED 2020**

PROVIDE 3 ROWS OF 3/4" ARDOX SPIRAL NAILS @ 8" O/C FOR MULTI-PLY NAILING, MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS



DWG NO. YAM 6085-20

STRUCTURAL COMPONENT ONLY**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****2ND FLR FRAMING\Flush Beams\B14B(i2247) (Flush Beam)****PASSED**

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code: WATERDOWN

Customer:

Code reports: CCMC 12472-R

Dry | 1 span | No cant.

February 10, 2020 12:41:53


File name: MOUNTAINASH 6 EL 2.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B14B(i2247)

Specifier:

Designer: AJ

Company:

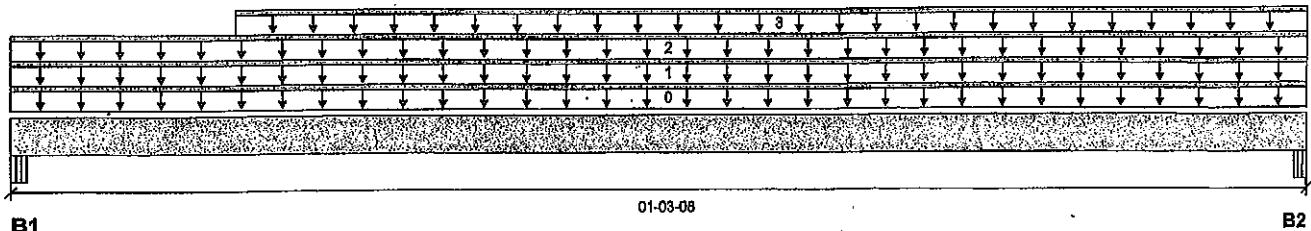

Total Horizontal Product Length = 01-03-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 2-5/8"	12 / 0	59 / 0	23 / 0	
B2, 5-1/4"	17 / 0	83 / 0	32 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	01-03-08	Top	1.00	0.65	1.00	1.15	00-00-00
1	SNOW	Unf. Lin. (lb/ft)	L	00-00-00	01-03-08	Top	22	20	42		n/a
2	WALL	Unf. Lin. (lb/ft)	L	00-00-00	01-03-08	Top		80			n/a
3	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-02-10	01-03-08	Top	1				n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	11 ft-lbs	15093 ft-lbs	n/a	0	00-06-07
End Shear	49 lbs	7521 lbs	0.6%	0	00-02-10
Span / Depth	1.0				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1 Beam	2-5/8" x 3-1/2"	82 lbs	2.6%	1.1%	Unspecified
B2 Beam	5-1/4" x 3-1/2"	116 lbs	1.8%	0.8%	Unspecified

Notes

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.


Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020

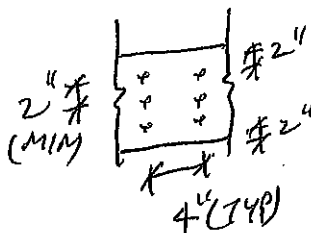

PROVIDE 3 ROWS OF 3/4" ARDOX
SPIRAL NAILS @ 4" O/C FOR
MULTI-PLY NAILING, MAINTAIN
A MIN. 2" LUMBER EDGE/END
DISTANCE. DO NOT USE AIR NAILS



OWN NO. TAM6095 -20
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCi®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP
2ND FLR FRAMING\Flush Beams\B14B(12805) (Flush Beam)
 Dry | 2 spans | R cant.


PASSED

BC CALCC® Member Report
 Build 7773

February 9, 2021 11:25:17

Job name:
 Address:
 City, Province, Postal Code: WATERDOWN
 Customer:
 Code reports: CCMC 12472-R

File name: MOUNTAINASH 6 EL 3.mmdl
 Description: 2ND FLR FRAMING\Flush Beams\B14B(12805)
 Specifier:
 Designer: AJ
 Company:

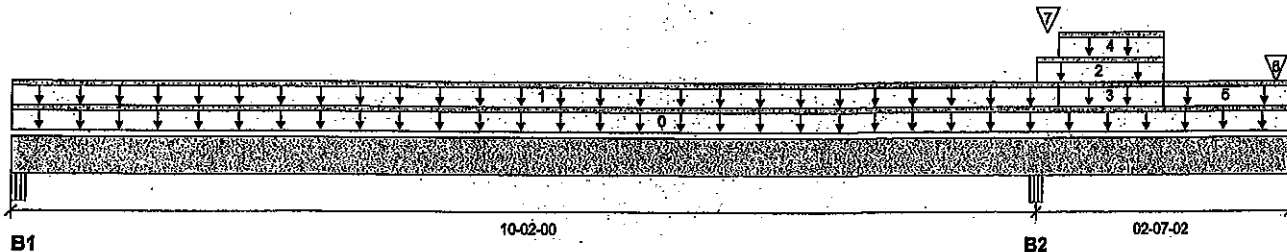

Total Horizontal Product Length = 12-09-02

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 2-5/8"	102 / 3	70 / 0	0 / 160	
B2, 5-1/4"	143 / 0	345 / 0	871 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	12-09-02	Top		10			00-00-00
1	FC2 Floor Decking (Plan View Fill)	Unf. Lin. (lb/ft)	L	00-00-00	10-04-10	Top	20	10			n/a
2	SNOW	Unf. Lin. (lb/ft)	L	10-02-00	11-05-08	Top	22	20	42		n/a
3	WALL	Unf. Lin. (lb/ft)	L	10-04-10	11-05-08	Top		51			n/a
4	FC2 Floor Decking (Plan View Fill)	Unf. Lin. (lb/ft)	L	10-04-10	11-05-08	Top	8	4			n/a
5	SOW	Unf. Lin. (lb/ft)	L	11-05-08	12-09-02	Top			63		n/a
6		Conc. Pt. (lbs)	L	12-07-06	12-07-06	Top		88	575		n/a
7	WALL	Conc. Pt. (lbs)	L	10-03-05	10-03-05	Top		17			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/ Resistance	Case	Location
Pos. Moment	497 ft-lbs	23219 ft-lbs	2.1%	32	04-05-08
Neg. Moment	-2816 ft-lbs	-18777 ft-lbs	15.0%	37	10-02-00
End Shear	186 lbs	11571 lbs	1.6%	32	01-00-02
Cont. Shear	1167 lbs	11571 lbs	10.1%	37	11-02-02
Total Load Deflection	2xL/1998 (0.064")	n/a	n/a	83	12-09-02
Live Load Deflection	2xL/1998 (0.06")	n/a	n/a	121	12-09-02
Total Neg. Defl.	L/999 (-0.035")	n/a	n/a	83	06-01-03
Max Defl.	-0.035"	n/a	n/a	83	06-01-03
Span / Depth	12.6				

Bearing Supports	Dim. (LxW)	Demand	Demand/ Resistance Support	Demand/ Resistance Member	Material
B1 Beam	2-5/8" x 3-1/2"	240 lbs	4.9%	2.1%	Unspecified
B1 Uplift		180 lbs			
B2 Beam	5-1/4" x 3-1/2"	1881 lbs	19.2%	8.4%	Unspecified

Cautions

Uplift of 180 lbs found at bearing B1. (SIMPSON 2-H2-3-A-2 (B1))



DRG NO. YAM 2467-21
 STRUCTURAL
 COMPONENT ONLY



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

2ND FLR FRAMING\Flush Beams\B14B(12805) (Flush Beam)

PASSED

BC CALC® Member Report
Build 7773

Dry | 2 spans | R cant

February 9, 2021 11:25:17

Job name:
Address:
City, Province, Postal Code: WATERDOWN
Customer:
Code reports: CCMC 12472-R

File name: MOUNTAINASH 6 EL 3.mmdl
Description: 2ND FLR FRAMING\Flush Beams\B14B(12805)
Specifier:
Designer: AJ
Company:


Notes

Design meets User specified (2xL/240) Total load deflection criteria.
Design meets User specified (2xL/360) Live load deflection criteria.
Resistance Factor phi has been applied to all presented results per CSA O86.
BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.
Unbalanced snow loads determined from building geometry were used in selected product's verification.
Design based on Dry Service Condition.
Importance Factor : Normal Part code : Part 9
Cantilevers require sheathed bottom flanges, blocking at cantilever support and closure at ends.
Calculations assume unbraced length of Top: 01-00-02, Bottom: 07-11-06.

CONFORMS TO OBC 2012

AMENDED 2020

Connection Diagram: Full Length of Member

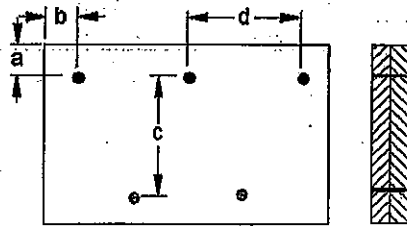

a minimum = 2" c = 5-1/2"
b minimum = 3" d = 6"

Calculated Side Load = 270.6 lb/ft

Connectors are: Nails

3/4" ARDOX SPIRAL



OWG NO. YAM 2467-21
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®



Boise Cascade



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

2ND FLR FRAMING\Flush Beams\B16\I2154) (Flush Beam)

PASSED

BC CALC® Member Report

Dry | 1 span | No cant.

February 10, 2020 11:38:52

Build 7239

Job name:

File name: MOUNTAINASH 6 EL 1.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B16\I2154)

City, Province, Postal Code:

Specifier:


Customer:

Designer:

Code reports:

CCMC 12472-R

Company:

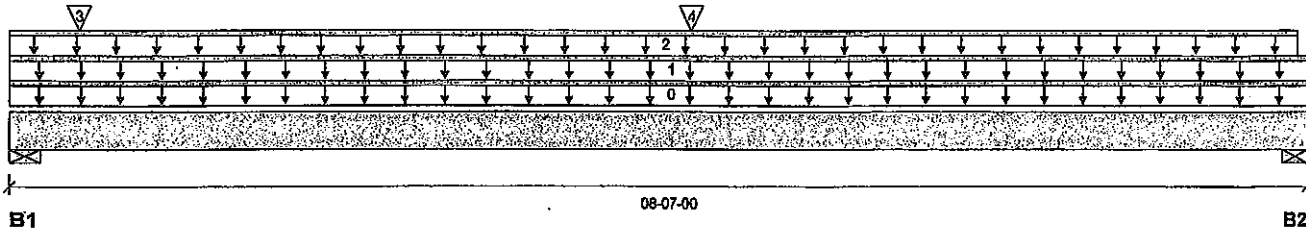

Total Horizontal Product Length = 08-07-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-1/2"	184 / 0	517 / 0	187 / 0	
B2, 5-1/2"	120 / 0	452 / 0	65 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	08-07-00	Top	1.00	0.85	1.00	1.15	00-00-00
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	08-07-00	Top	20	10			n/a
2	WALL	Unf. Lin. (lb/ft)	L	00-00-00	08-06-01	Top		80			n/a
3	WINDOW	Conc. Pt. (lbs)	L	00-05-00	00-05-00	Top	66	60	126		n/a
4	WINDOW	Conc. Pt. (lbs)	L	04-05-00	04-05-00	Top	66	60	126		n/a

Controls Summary

Pos.	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Moment	1221 ft-lbs	15093 ft-lbs	8.1%	0	04-05-00
End Shear	468 lbs	7521 lbs	6.2%	0	07-04-00
Total Load Deflection	L/999 (0.028")	n/a	n/a	35	04-03-13
Live Load Deflection	L/999 (0.01")	n/a	n/a	51	04-03-13
Max Defl.	0.028"	n/a	n/a	35	04-03-13
Span / Depth	9.8				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 5-1/2" x 3-1/2"	723 lbs	9.4%	4.7%	Spruce-Pine-Fir
B2	Wall/Plate 5-1/2" x 3-1/2"	633 lbs	8.2%	4.1%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.


Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.


Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020



PROVIDE 2 ROWS OF 3/4" ARDOX
SPIRAL NAILS @ 12" O/C FOR
MULTI-PLY NAILING. MAINTAIN
A MIN. 2" LUMBER EDGE/END
DISTANCE. DO NOT USE AIR NAILS

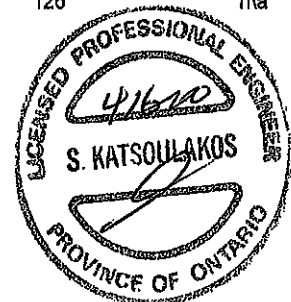**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current installation Guide and applicable building codes. To obtain installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

REG NO. TAM 6086-20

STRUCTURAL



Boise Cascade

**Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****1ST FLR FRAMING\Flush Beams\B16 H(i6553) (Flush Beam)****PASSED**

BC CALC® Member Report

Dry | 1 span | No cant.

September 17, 2020 07:57:48

Build 7493

Job name:

File name: MOUNTAINASH 6

Address:

Description: 1ST FLR FRAMING\Flush Beams\B16 H(i6553)

City, Province, Postal Code: WATERDOWN


Specifier:

Customer:

Designer: AJ

Code reports: CCMC 12472-R

Company:

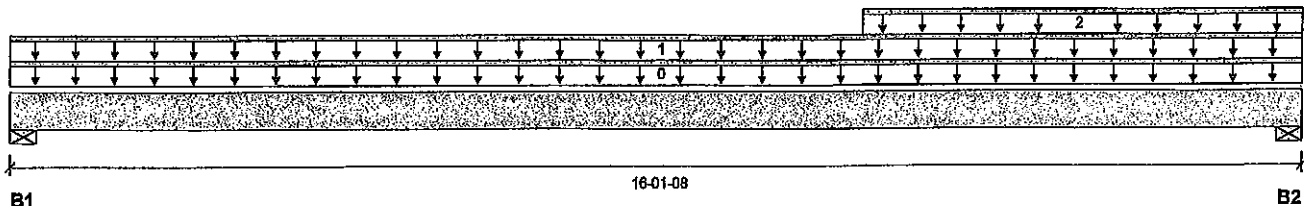

Total Horizontal Product Length = 16-01-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 1-7/8"	110 / 0	94 / 0		
B2, 4-1/8"	124 / 0	101 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	16-01-08	Top		5			00-00-00
1	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	16-01-08	Top	14	7			n/a
2	FC1 Floor Material	Unf. Lin. (lb/ft)	L	10-06-14	16-01-08	Top	3	1			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/ Resistance	Case	Location
Pos. Moment	1122 ft-lbs	11610 ft-lbs	9.7%	1	08-02-00
End Shear	286 lbs	5785 lbs	4.6%	1	14-11-14
Total Load Deflection	L/1302 (0.145")	n/a	18.4%	4	08-00-03
Live Load Deflection	L/999 (0.079")	n/a	n/a	5	08-00-03
Max Defl.	0.145"	n/a	n/a	4	08-00-03
Span / Depth	19.9				

Bearing Supports

	Dim. (LxW)	Demand	Demand/ Resistance Support	Demand/ Resistance Member	Material
B1	Wall/Plate 1-7/8" x 1-3/4"	283 lbs	14.0%	7.1%	Spruce-Pine-Fir
B2	Wall/Plate 4-1/8" x 1-3/4"	313 lbs	7.0%	3.6%	/Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020



BWA NO. 4AM/2007-20

STRUCTURAL

COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



BOLSCASCADE

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****1ST FLR FRAMING\Flush Beams\B17(I2700) (Flush Beam)**

BC CALC® Member Report

Dry | 1 span | No cant.

August 28, 2020 09:26:19

Build 7493

Job name:

File name: MOUNTAINASH 6 EL 3

Address:

Description: 1ST FLR FRAMING\Flush Beams\B17(I2700)

City, Province, Postal Code: HAMILTON

Specifier:


Customer:

Designer: CH

Code reports:

CCMC 12472-R

Company:

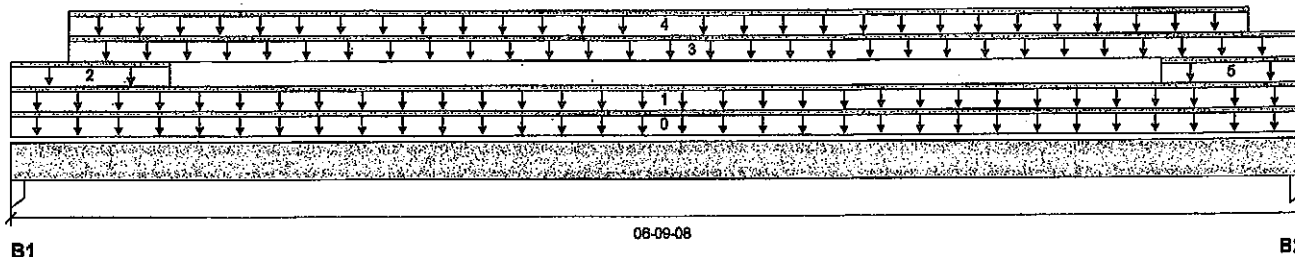

Total Horizontal Product Length = 06-09-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3-1/2"	538 / 0	1073 / 0		
B2, 3-1/2"	227 / 0	768 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	06-09-08	Top		10			00-00-00
1	5(I782)	Unf. Lin. (lb/ft)	L	00-00-00	06-09-08	Top		81			n/a
2	5(I782)	Unf. Lin. (lb/ft)	L	00-00-00	00-09-12	Top	481	612			n/a
3	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-03-08	06-09-08	Top	20	10			n/a
4	5(I782)	Unf. Lin. (lb/ft)	L	00-03-08	06-06-00	Top	31	80			n/a
5	5(I782)	Unf. Lin. (lb/ft)	L	06-00-08	06-09-08	Top	71	221			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/ Resistance	Case	Location
Pos. Moment	1363 ft-lbs	15093 ft-lbs	9.0%	0	03-03-14
End Shear	1010 lbs	7521 lbs	13.4%	0	01-01-00
Total Load Deflection	L/999 (0.019")	n/a	n/a	4	03-04-12
Live Load Deflection	L/999 (0.004")	n/a	n/a	5	03-03-14
Max Defl.	0.019"	n/a	n/a	4	03-04-12
Span / Depth	8.0				

			Demand/ Resistance Support	Demand/ Resistance Member		
Bearing Supports	Dim. (LxW)	Demand			Material	
B1	Column	3-1/2" x 3-1/2"	1503 lbs	23.2%	15.5%	Unspecified
B2	Column	3-1/2" x 3-1/2"	1075 lbs	16.6%	11.1%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020



www.no.tam/12117 -20

STRUCTURAL

COMPONENT ONLY



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****1ST FLR FRAMING\Flush Beams\B17(I2700) (Flush Beam)****PASSED**

August 26, 2020 09:26:19

BC CALC® Member Report

Build 7493

Job name:

Address:

City, Province, Postal Code: HAMILTON

Customer:

Code reports: CCMC 12472-R

Dry | 1 span | No cant.


File name: MOUNTAINASH 6 EL 3

Description: 1ST FLR FRAMING\Flush Beams\B17(I2700)

Specifier:

Designer: CH

Company:

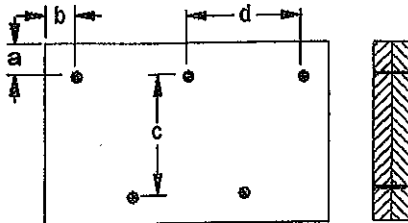Connection Diagram: Full Length of Member

a minimum = 2"

c = 5-1/2"

b minimum = 3"

d = 4"

Connectors are: 1 Nails

3-1/2" ARDOX SPIRAL

SWS NO. 44W 12117-20

**STRUCTURAL
COMPONENT ONLY****Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****2ND FLR FRAMING\Flush Beams\B17D(I3135) (Flush Beam)****PASSED**

BC CALC® Member Report

Build 7493

Job name:

Address:

City, Province, Postal Code: WATERDOWN

Customer:

Code reports: CCMC 12472-R

Dry | 2 spans | L cant.

November 25, 2020 08:03:28


File name: MOUNTAINASH 6 EL 3 LOT 12.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B17D(I3135)

Specifier:

Designer: AJ

Company:

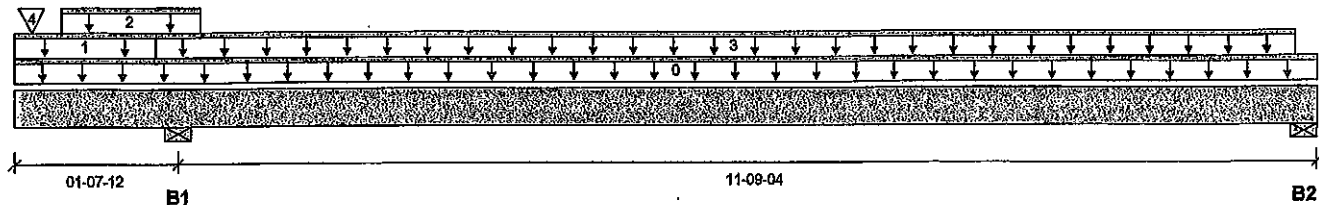

Total Horizontal Product Length = 13-05-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-1/2"	179 / 0	884 / 0	367 / 0	
B2, 5-1/2"	117 / 6	38 / 0	0 / 43	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	13-05-00	Top		10			00-00-00
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	01-05-00	Top	15	7			n/a
2	E30(I3261)	Unf. Lin. (lb/ft)	L	00-05-08	01-10-08	Top		81			n/a
3	FC2 Floor Material	Unf. Lin. (lb/ft)	L	01-05-00	13-02-04	Top	20	10			n/a
4	-	Conc. Pt. (lbs)	L	00-01-13	00-01-13	Top	33	550	324		n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/ Resistance	Case	Location
Pos. Moment	419 ft-lbs	23220 ft-lbs	1.8%	36	08-10-13
Neg. Moment	-1265 ft-lbs	-15093 ft-lbs	8.4%	0	01-07-12
End Shear	165 lbs	11571 lbs	1.4%	33	12-02-00
Cont. Shear	1246 lbs	11571 lbs	10.8%	37	00-07-08
Total Load Deflection	2xL/1998 (0.029")	n/a	n/a	82	00-00-00
Live Load Deflection	L/999 (-0.016")	n/a	n/a	120	06-06-05
Total Neg. Defl.	L/999 (-0.028")	n/a	n/a	82	05-11-03
Max Defl.	-0.028"	n/a	n/a	82	05-11-03
Span / Depth	14.4				

Bearing Supports	Dim. (LxW)	Demand	Demand/ Resistance Support	Demand/ Resistance Member	Material
B1	Wall/Plate 5-1/2" x 3-1/2"	1238 lbs	16.1%	8.1%	Spruce-Pine-Fir
B2	Wall/Plate 5-1/2" x 3-1/2"	223 lbs	1.9%	0.9%	Spruce-Pine-Fir

Cautions

Concentrated side load(s) 2 are closer than 18" from end of member. Please consult a technical representative or Professional of Record.



OWN NO. YAM16095-20
STRUCTURAL
COMPONENT ONLY



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****2ND FLR FRAMING\Flush Beams\B17D(I3135) (Flush Beam)****PASSED**

BC CALC® Member Report

Build 7493

Job name:

Address:

City, Province, Postal Code: WATERDOWN

Customer:

Code reports: CCMC 12472-R

Dry | 2 spans | L cant.

November 25, 2020 08:03:28

File name: MOUNTAINASH 6 EL 3 LOT 12.mmjdl

Description: 2ND FLR FRAMING\Flush Beams\B17D(I3135)

Specifier:

Designer: AJ

Company:

Notes

Design meets User specified (2xL/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected product's verification.


Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Cantilevers require sheathed bottom flanges, blocking at cantilever support and closure at ends.

CONFORMS TO UBC 2.3.12

AMENDED 2020

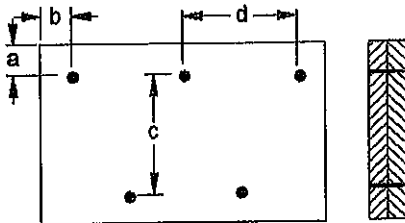Connection Diagram: Full Length of Member

a minimum = 2"

b minimum = 3"

c = 5-1/2"

d = 8"

Calculated Side Load = 227.3 lb/ft

Connectors are: 1 3-1/2" ARDOX SPIRAL

3-1/2" ARDOX SPIRAL

BWA NO. YAM 16085-20
STRUCTURAL
COMPONENT ONLY**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

2ND FLR FRAMING\Dropped Beams\B17C(12957) (Dropped Beam)

PASSED

BC CALC® Member Report

Dry | 1 span | No cant.

February 9, 2021 11:25:17

Build 7773

Job name:

File name: MOUNTAINASH 6 EL 3.mmdl

Address:

Description: 2ND FLR FRAMING\Dropped Beams\B17C

City, Province, Postal Code: WATERDOWN

Specifier:


Customer:

Designer: AJ

Code reports:

CCMC 12472-R

Company:



B1

10-02-00

B2

Total Horizontal Product Length = 10-02-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 2"		49 / 0	320 / 0	
B2, 2"		49 / 0	320 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	10-02-00	Top		10			00-00-00
1	SOW	Unf. Lin. (lb/ft)	L	00-00-00	10-02-00	Top			63		n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/ Resistance	Case	Location
Pos. Moment	1321 ft-lbs	15950 ft-lbs	8.3%	1	05-01-00
End Shear	439 lbs	11571 lbs	3.8%	1	00-11-08
Total Load Deflection	L/999 (0.032")	n/a	n/a	12	05-01-00
Live Load Deflection	L/999 (0.028")	n/a	n/a	17	05-01-00
Max Defl.	0.032"	n/a	n/a	12	05-01-00
Span / Depth	12.6				

Bearing Supports	Dim. (LxW)	Demand	Demand/ Resistance Support	Demand/ Resistance Member	Material
B1	Hanger 2" x 3-1/2"	542 lbs	n/a	6.3%	HUC410
B2	Hanger 2" x 3-1/2"	542 lbs	n/a	6.3%	HUC410

Cautions

Header for the hanger HUC410 is a Double 1-3/4" x 9-1/2" LVL Beam.

Hanger model HUC410 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected product's verification.


Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Calculations assume unbraced length of Top: 10-02-00, Bottom: 10-02-00.

CONFORMS TO OBC 2012

AMENDED 2020

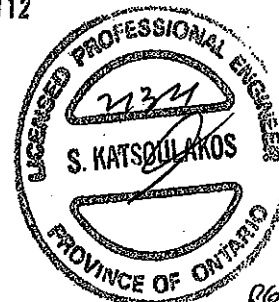

OWN NO. 2466-21
STRUCTURAL
COMPONENT ONLY



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

BC CALC® Member Report
Build 7773


2ND FLR FRAMING\Dropped Beams\B17C (I2957) (Dropped Beam)
Dry | 1 span | No cant.

February 9, 2021 11:25:17

Job name:
Address:
City, Province, Postal Code: WATERDOWN
Customer:
Code reports: CCMC 12472-R

File name: MOUNTAINASH 6 EL 3.mmdl
Description: 2ND FLR FRAMING\Dropped Beams\B17C
Specifier:
Designer: AJ
Company:

Connection Diagram: Full Length of Member

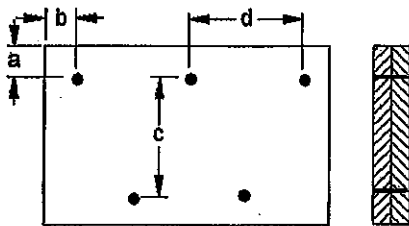

a minimum = 2"
b minimum = 3"

c = 5-1/2"
d = 6"

Connectors are: 3/4" ARDOX SPIRAL Nails



OWG NO. YAH 246621
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJST™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Flush Beams\B18D(I3150) (Flush Beam)**

Dry | 2 spans | L cant.

November 25, 2020 08:03:28

BC CALC® Member Report

Build 7493

Job name:

Address:

City, Province, Postal Code: WATERDOWN

Customer:

Code reports: CCMC 12472-R


File name: MOUNTAINASH 6 EL 3 LOT 12.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B18D(I3150)

Specifier:

Designer: AJ

Company:

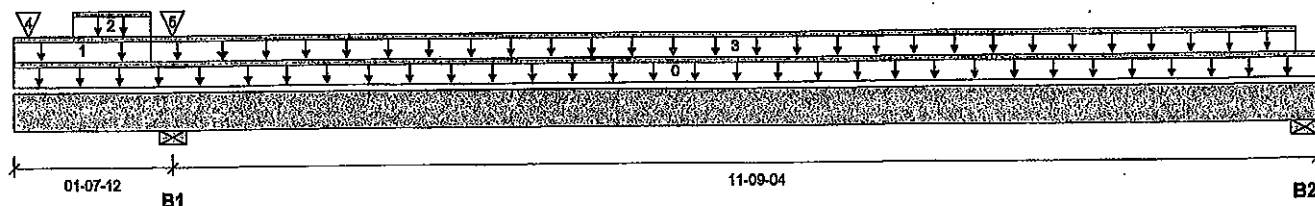**Reaction Summary (Down / Uplift) (lbs)**

Bearing	Live	Dead	Snow	Wind
B1, 5-1/2"	222 / 0	906 / 0	387 / 0	
B2, 5-1/2"	117 / 12	34 / 0	0 / 45	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	13-05-00	Top		10			00-00-00
1	E28(I3262)	Unf. Lin. (lb/ft)	L	00-00-00	01-05-00	Top		81			n/a
2	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-07-04	01-05-00	Top	10				n/a
3	FC2 Floor Material	Unf. Lin. (lb/ft)	L	01-05-00	13-02-04	Top	20	10			n/a
4	-	Conc. Pt. (lbs)	L	00-01-13	00-01-13	Top	84	550	342		n/a
5	E23(I3255)	Conc. Pt. (lbs)	L	01-07-12	01-07-12	Top		24			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	403 ft-lbs	23220 ft-lbs	1.7%	36	08-10-13
Neg. Moment	-2083 ft-lbs	-23220 ft-lbs	9.0%	37	01-07-12
End Shear	159 lbs	11571 lbs	1.4%	33	12-02-00
Cont. Shear	1356 lbs	11571 lbs	11.7%	37	00-07-08
Total Load Deflection	2xL/1998 (0.032")	n/a	n/a	82	00-00-00
Live Load Deflection	L/999 (-0.018")	n/a	n/a	120	06-08-05
Total Neg. Defl.	L/999 (-0.031")	n/a	n/a	82	06-01-00
Max Defl.	-0.031"	n/a	n/a	82	06-01-00
Span / Depth	14.4				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 5-1/2" x 3-1/2"	1268 lbs	16.5%	8.3%	Spruce-Pine-Fir
B2	Wall/Plate 5-1/2" x 3-1/2"	218 lbs	1.8%	0.9%	Spruce-Pine-Fir

Cautions

Concentrated side load(s) 2 are closer than 18" from end of member. Please consult a technical representative or Professional of Record.



OWN NO. 1AM16096-20
STRUCTURAL
COMPONENT ONLY



Boise Cascade



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

2ND FLR FRAMING\Flush Beams\B18D(I3150) (Flush Beam)

PASSED

BC CALC® Member Report

Build 7493

Job name:

Address:

City, Province, Postal Code: WATERDOWN

Customer:

Code reports: CCMC 12472-R

Dry | 2 spans | L cant.

November 25, 2020 08:03:28

File name: MOUNTAINASH 6 EL 3 LOT 12.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B18D(I3150)

Specifier:

Designer: AJ

Company:

Notes

Design meets User specified (2xL/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Cantilevers require sheathed bottom flanges, blocking at cantilever support and closure at ends.

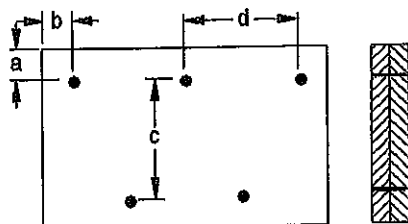CONFORMS TO OBC 2012**AMENDED 2020****Connection Diagram: Full Length of Member**

a minimum = 2"

b minimum = 3"

c = 5-1/2"

d = 6"

Calculated Side Load = 231.8 lb/ft

Connectors are: 1. Nails

3-1/2" ARDOX SPIRAL

112620
S. KATSOUKAKOS
PROVINCE OF ONTARIO

862

ENG NO. 74M/6096-20
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Flush Beams\B18 (12958) (Flush Beam)**

BC CALC® Member Report

Dry | 1 span | No cant.

February 9, 2021 11:25:17

Build 7773

Job name:

File name: MOUNTAINASH 6 EL 3.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B18

City, Province, Postal Code: WATERDOWN

Specifier:


Customer:

Designer: AJ

Code reports:

CCMC 12472-R

Company:

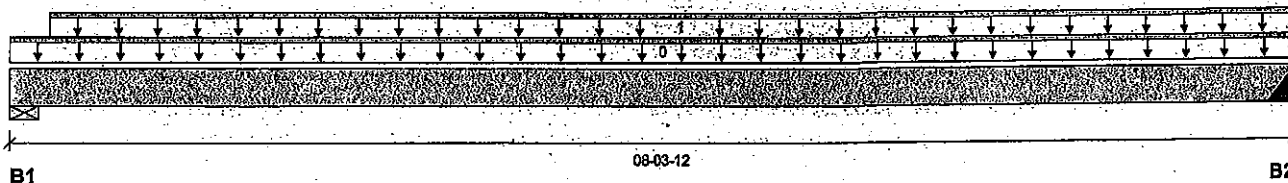**Reaction Summary (Down / Uplift) (lbs)**

Bearing	Live	Dead	Snow	Wind
B1, 2-3/4"		40 / 0	249 / 0	
B2, 2"		40 / 0	260 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	08-03-12	Top		10			00-00-00
1	SOW	Unf. Lin. (lb/ft)	L	00-02-12	08-03-12	Top			63		n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	861 ft-lbs	18624 ft-lbs	4.6%	1	04-02-04
End Shear	337 lbs	11571 lbs	2.9%	1	01-00-04
Total Load Deflection	L/999 (0.014")	n/a	n/a	12	04-02-04
Live Load Deflection	L/999 (0.012")	n/a	n/a	17	04-02-04
Max Defl.	0.014"	n/a	n/a	12	04-02-04
Span / Depth	10.2				

Bearing Supports	Dim. (LxW)	Demand	Demand/ Resistance Support	Demand/ Resistance Member	Material	
B1	Wall/Plate	2-3/4" x 3-1/2"	424 lbs	7.2%	3.6%	Spruce-Pine-Fir
B2	Hanger	2" x 3-1/2"	439 lbs	n/a	5.1%	HUC410

Cautions

Header for the hanger HUC410 is a Double 1-3/4" x 9-1/2" LVL Beam.

Hanger model HUC410 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

Calculations assume unbraced length of Top: 08-01-00, Bottom: 08-01-00.

CONFORMS TO OBC 2012

AMENDED 2020



006 NO. 7AM2468-21
STRUCTURAL
COMPONENT ONLY



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP
2ND FLR FRAMING\Flush Beams\B18C(12958) (Flush Beam)

PASSED

BC CALC® Member Report

Build 7773

Job name:

Address:

City, Province, Postal Code: WATERDOWN

Customer:

Code reports: CCMC 12472-R

Dry | 1 span | No cant.

February 9, 2021 11:25:17

File name: MOUNTAINASH 6 EL 3.mmdl


Description: 2ND FLR FRAMING\Flush Beams\B18C

Specifier:

Designer: AJ

Company:

Connection Diagram: Full Length of Member

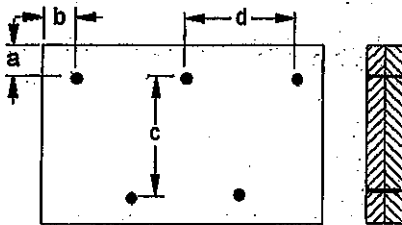

a minimum = 2"

b minimum = 3"

c = 5-1/2"

d = 8"

Connectors are: 1 Nails

3/4" ARDOX SPIRAL




ONE NO. 44W 2460-21

**STRUCTURAL
COMPONENT ONLY**

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®

**Quadruple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Flush Beams\B19(i2627) (Flush Beam)**

BC CALC® Member Report

Dry | 1 span | No cant.

August 26, 2020 09:26:19

Build 7493

Job name:

File name: MOUNTAINASH 6 EL 3

Address:

Description: 2ND FLR FRAMING\Flush Beams\B19(i2627)

City, Province, Postal Code: HAMILTON

Specifier:


Customer:

Designer: CH

Code reports:

CCMC 12472-R

Company:

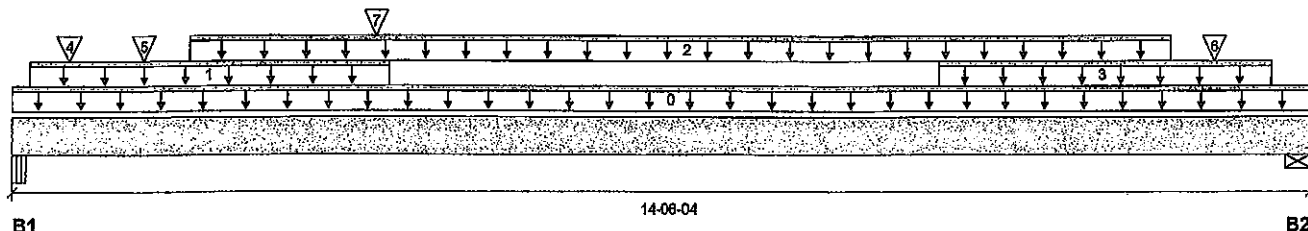

Total Horizontal Product Length = 14-06-04

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 4-1/2"	2856 / 0	1769 / 0		
B2, 5-1/2"	3171 / 0	1798 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	14-06-04	Top		19			00-00-00
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-02-04	04-01-04	Top	22	11			n/a
2	Smoothed Load	Unf. Lin. (lb/ft)	L	01-11-04	12-11-04	Top	342	170			n/a
3	STAIRS	Unf. Lin. (lb/ft)	L	10-03-04	14-00-12	Top	240	120			n/a
4	J7(i2837)	Conc. Pt. (lbs)	L	00-07-04	00-07-04	Top	324	162			n/a
5	J7(i2847)	Conc. Pt. (lbs)	L	01-05-04	01-05-04	Top	305	152			n/a
6	J7(i3121)	Conc. Pt. (lbs)	L	13-05-04	13-05-04	Top	325	162			n/a
7	B18(i2803)	Conc. Pt. (lbs)	L	03-11-08	03-11-08	Top	301	426			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	21829 ft-lbs	48297 ft-lbs	45.2%	1	07-05-04
End Shear	6416 lbs	23142 lbs	27.7%	1	13-03-04
Total Load Deflection	L/306 (0.542")	n/a	78.6%	4	07-02-04
Live Load Deflection	L/489 (0.339")	n/a	73.6%	6	07-02-04
Max Defl.	0.542"	n/a	n/a	4	07-02-04
Span / Depth	17.4				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1 Beam	4-1/2" x 7"	6495 lbs	38.6%	16.9%	Unspecified
B2 Wall/Plate	5-1/2" x 7"	7004 lbs	29.6%	14.9%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume unbraced length of Top: 00-00-00, Bottom: 00-00-00.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020



OWG NO. 12119-20
STRUCTURAL
COMPONENT ONLY



Boise Cascade

**Quadruple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Flush Beams\B19(i2627) (Flush Beam)**

Dry | 1 span | No cant.

August 26, 2020 09:26:19

BC CALC® Member Report

Build 7493

Job name:

File name: MOUNTAINASH 6 EL 3

Address:

Description: 2ND FLR FRAMING\Flush Beams\B19(i2627)

City, Province, Postal Code: HAMILTON


Specifier:

Customer:

Designer: CH

Code reports: CCMC 12472-R

Company:

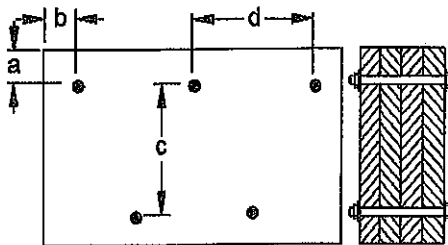Connection Diagram: Full Length of Member

a minimum = 2-1/2" c = 4-1/2"
 b minimum = 3-1/8" d = 1-1/2"

Calculated Side Load = 731.0 lb/ft

Bolts are assumed to be Grade A307 or Grade 2 or higher.

Connectors are: 5/8 in. Staggered Through Bolt



SWG NO. TAM 12119-20
**STRUCTURAL
 COMPONENT ONLY**

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®.



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****2ND FLR FRAMING\Flush Beams\B19D(I3184) (Flush Beam)****PASSED**

BC CALC® Member Report

Dry | 1 span | No cant.

November 25, 2020 08:03:28

Build 7493

Job name:

File name: MOUNTAINASH 6 EL 3 LOT 12.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B19D(I3184)

City, Province, Postal Code: WATERDOWN

Specifier:


Customer:

Designer: AJ

Code reports:

CCMC 12472-R

Company:

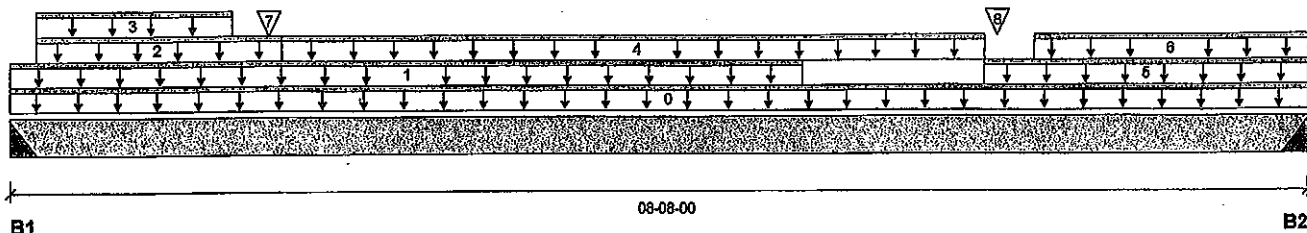**Reaction Summary (Down / Uplift) (lbs)**

Bearing	Live	Dead	Snow	Wind
B1, 2"	78 / 0	528 / 0	301 / 0	
B2, 2"	33 / 0	523 / 0	311 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.85	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	08-08-00	Top		10			00-00-00
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	05-02-08	Top	22	11			n/a
2	E29(I3263)	Unf. Lin. (lb/ft)	L	00-02-00	01-09-08	Top		81			n/a
3	E29(I3263)	Unf. Lin. (lb/ft)	L	00-02-00	01-05-08	Top		28	72		n/a
4	E31(I3264)	Unf. Lin. (lb/ft)	L	01-09-08	06-05-08	Top		61			n/a
5	E32(I3265)	Unf. Lin. (lb/ft)	L	06-05-08	08-08-00	Top		81			n/a
6	E32(I3265)	Unf. Lin. (lb/ft)	L	06-09-08	08-08-00	Top		28	72		n/a
7	E29(I3263)	Conc. Pt. (lbs)	L	01-08-08	01-08-08	Top		115	193		n/a
8	E32(I3265)	Conc. Pt. (lbs)	L	06-06-08	06-06-08	Top		114	191		n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1364 ft-lbs	15093 ft-lbs	9.0%	0	04-04-04
End Shear	978 lbs	11571 lbs	8.5%	13	00-11-08
Total Load Deflection	L/999 (0.042")	n/a	n/a	35	04-04-04
Live Load Deflection	L/999 (0.016")	n/a	n/a	51	04-04-04
Max Defl.	0.042"	n/a	n/a	35	04-04-04
Span / Depth	10.7				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1 Hanger	2" x 3-1/2"	1189 lbs	n/a	13.9%	Hanger
B2 Hanger	2" x 3-1/2"	1154 lbs	n/a	13.5%	Hanger

Cautions

Hanger model Hanger was not found. Hanger has not been analyzed for adequate capacity.



046 NO. TAM 16097 = 20
STRUCTURAL
COMPONENT ONLY



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP
2ND FLR FRAMING\Flush Beams\B19D(I3184) (Flush Beam)

PASSED

BC CALC® Member Report

Dry | 1 span | No cant.

November 25, 2020 08:03:28

Build 7493

Job name:

File name: MOUNTAINASH 6 EL 3 LOT 12.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B19D(I3184)

City, Province, Postal Code: WATERDOWN

Specifier:

Customer:

Designer: AJ

Code reports: CCMC 12472-R

Company:

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

CONFORMS TO OBC 2012

Resistance Factor phi has been applied to all presented results per CSA O86.

AMENDED 2020


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Connection Diagram: Full Length of Member

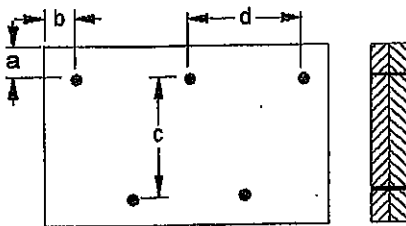


a minimum = 2"
b minimum = 3"

c = 5-1/2"
d = 3-1/2"

Connectors are: Nails

3-1/2" ARDOX SPIRAL

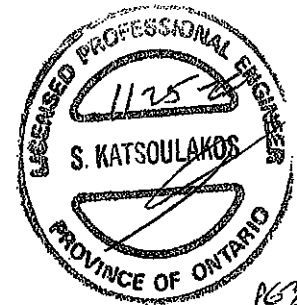

ENG NO. 1125-20
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

2ND FLR FRAMING\Flush Beams\B19c (I2960) (Flush Beam)

PASSED

BC CALC® Member Report

Build 7773

Job name:

Address:

City, Province, Postal Code: WATERDOWN

Customer:

Code reports: CCMC 12472-R

Dry | 1 span | R cant.

February 9, 2021 11:25:17


File name: MOUNTAINASH 6 EL 3.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B19c

Specifier:

Designer: AJ

Company:

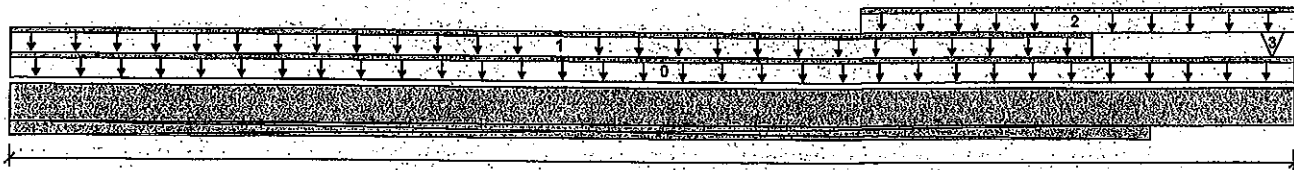

B1

08-01-00

Total Horizontal Product Length = 08-01-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 85-7/8"	54 / 0	154 / 0	497 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	08-01-00	Top	1.00	0.65	1.00	1.15	00-00-00
1	FC2 Floor Decking (Plan View Fill)	Unf. Lin. (lb/ft)	L	00-00-00	08-09-06	Top	8	4			n/a
2	SOW	Unf. Lin. (lb/ft)	L	05-03-04	08-01-00	Top			63		n/a
3	B17D(I2957)	Conc. Pt. (lbs)	L	07-11-04	07-11-04	Top		49	320		n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	0 ft-lbs	23219 ft-lbs	n/a	23	08-01-00
Neg. Moment	-468 ft-lbs	-21266 ft-lbs	2.2%	13	07-01-14
End Shear	549 lbs	11571 lbs	4.7%	13	07-11-08
Total Load Deflection	2xL/1998 (0")	n/a	n/a	35	08-01-00
Live Load Deflection	2xL/1998 (0")	n/a	n/a	51	08-01-00
Span / Depth	1.2				
Dist. Load (B1)	107.37 lb/ft	57645.1 lb/ft	0.2%		

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 85-7/8" x 3-1/2"	992 lbs	0.5%	0.3%	Spruce-Pine-Fir

Notes

Design meets User specified (2xL/240) Total load deflection criteria.

Design meets User specified (2xL/360) Live load deflection criteria.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86. AMENDED 2020

Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Cantilevers require sheathed bottom flanges, blocking at cantilever support and closure at ends.

Calculations assume unbraced length of Top: 01-00-02, Bottom: 05-03-04.

CONFORMS TO OBC 2012



006 08. JAN 2469-26
STRUCTURAL
COMPONENT ONLY



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP
2ND FLR FRAMING\Flush Beams\B19C(12960) (Flush Beam)

PASSED

BC CALC® Member Report
 Bulld 7773


Dry | 1 span | R cant.

February 9, 2021 11:25:17

Job name:
 Address:
 City, Province, Postal Code: WATERDOWN
 Customer:
 Code reports: CCMC 12472-R

File name: MOUNTAINASH 6 EL 3.mmd!
 Description: 2ND FLR FRAMING\Flush Beams\B19C
 Specifier:
 Designer: AJ
 Company:

Connection Diagram: Full Length of Member

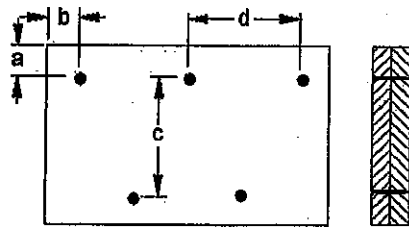

a minimum = 2"
 b minimum = 3"
 c = 5-1/2"
 d = 3"

Calculated Side Load = 270.6 lb/ft

Connectors are: 3/4" ARDOX SPIRAL Nails



Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of Input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®



Bolsee Cascade



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

2ND FLR FRAMING\Flush Beams\B20(i3104) (Flush Beam)

PASSED

BC CALC® Member Report

Dry | 2 spans | L cant.

August 26, 2020 09:26:19

Build 7493

Job name:

File name: MOUNTAINASH 6

Address:

Description: 2ND FLR FRAMING\Flush Beams\B20(i3104)

City, Province, Postal Code: HAMILTON

Specifier:


Customer:

Designer: CH

Code reports:

CCMC 12472-R

Company:

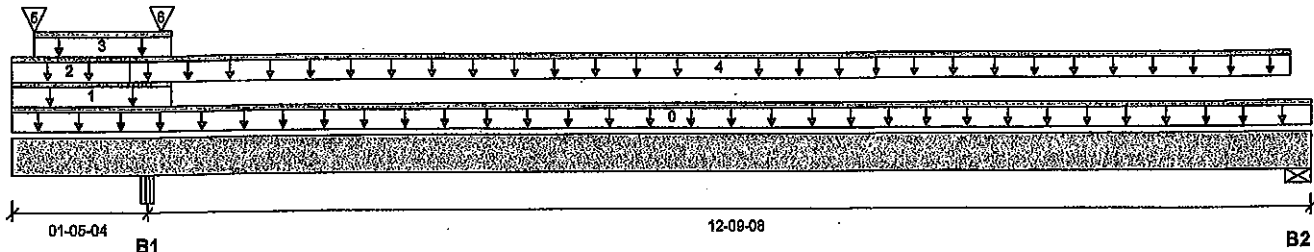

Total Horizontal Product Length = 14-02-12

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 4-1/2"	139 / 0	702 / 0	782 / 0	
B2, 5-1/2"	127 / 1	113 / 0	0 / 10	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.85	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	14-02-12	Top		10			00-00-00
1	E73(i1679)	Unf. Lin. (lb/ft)	L	00-00-00	01-08-08	Top		100			n/a
2	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	01-03-00	Top	8				n/a
3	E73(i1679)	Unf. Lin. (lb/ft)	L	00-02-12	01-08-08	Top		76	144		n/a
4	FC2 Floor Material	Unf. Lin. (lb/ft)	L	01-03-00	14-00-00	Top	20	10			n/a
5	E73(i1679)	Conc. Pt. (lbs)	L	00-02-12	00-02-12	Top		7	13		n/a
6	E73(i1679)	Conc. Pt. (lbs)	L	01-07-04	01-07-04	Top		255	547		n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	940 ft-lbs	23220 ft-lbs	4.1%	45	08-00-05
Neg. Moment	-417 ft-lbs	-23220 ft-lbs	1.8%	49	01-05-04
End Shear	273 lbs	11571 lbs	2.4%	43	12-11-12
Cont. Shear	342 lbs	11571 lbs	3.0%	1	02-05-00
Total Load Deflection	L/999 (0.036")	n/a	n/a	108	07-08-06
Live Load Deflection	L/999 (0.021")	n/a	n/a	160	07-08-06
Total Neg. Defl.	2xL/1998 (-0.012")	n/a	n/a	108	00-00-00
Max Defl.	0.036"	n/a	n/a	108	07-08-06
Span / Depth	15.7				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Beam 4-1/2" x 3-1/2"	2190 lbs	26.0%	11.4%	Unspecified
B2	Wall/Plate 5-1/2" x 3-1/2"	332 lbs	2.8%	1.4%	Spruce-Pine-Fir



92320
S. KATSOULAKOS
PROVINCE OF ONTARIO
1614
BWC NO. TAM/2006-20
STRUCTURAL
COMPONENT ONLY



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP
2ND FLR FRAMING\Flush Beams\B20(13104) (Flush Beam)****PASSED**

BC CALC® Member Report

Dry | 2 spans | L cant.

August 26, 2020 09:26:19

Build 7493

Job name:

File name: MOUNTAINASH 6

Address:

Description: 2ND FLR FRAMING\Flush Beams\B20(13104)

City, Province, Postal Code: HAMILTON

Specifier:

Customer:

Designer: CH

Code reports: CCMC 12472-R

Company:

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Cantilevers require sheathed bottom flanges, blocking at cantilever support and closure at ends.

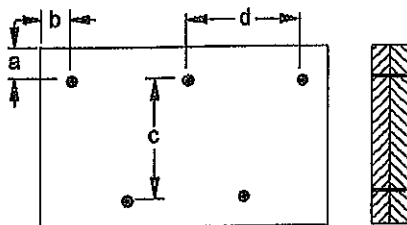Connection Diagram: Full Length of Member

a minimum = 2"

c = 5-1/2"

b minimum = 3"

d = 2-0/8"

Connectors are: 1. Nails

3-1/2" ARDOX SPIRAL**OWN NO. TAM 12886-20
STRUCTURAL
COMPONENT ONLY****Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Bolse Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****2ND FLR FRAMING\Flush Beams\B21(12792) (Flush Beam)****PASSED**

August 26, 2020 09:26:19

BC CALC® Member Report

Build 7493

Job name:

Address:

City, Province, Postal Code: HAMILTON

Customer:

Code reports: CCMC 12472-R

Dry | 2 spans | L cant.


File name: MOUNTAINASH 6

Description: 2ND FLR FRAMING\Flush Beams\B21(12792)

Specifier:

Designer: CH

Company:

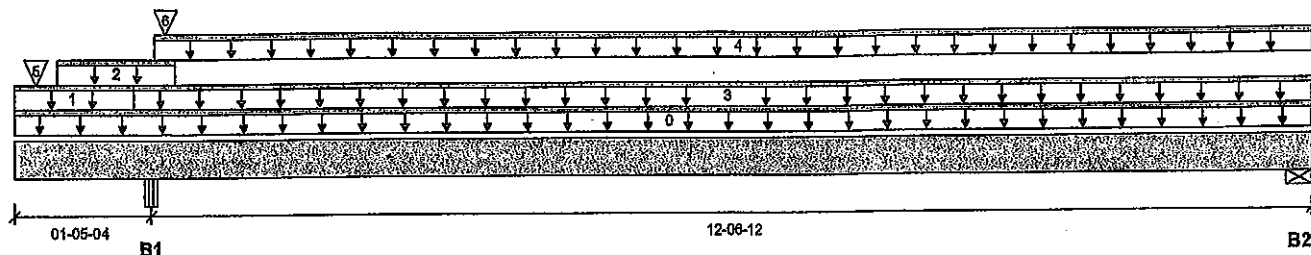

Total Horizontal Product Length = 14-00-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 4-1/2"	278 / 0	799 / 0	805 / 0	
B2, 2-3/4"	255 / 2	171 / 0	0 / 12	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	14-00-00	Top		10			00-00-00
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	01-03-00	Top	20	10			n/a
2	E75(1685)	Unf. Lin. (lb/ft)	L	00-05-08	01-08-08	Top		176	144		n/a
3	FC2 Floor Material	Unf. Lin. (lb/ft)	L	01-03-00	14-00-00	Top	23	11			n/a
4	FC2 Floor Material	Unf. Lin. (lb/ft)	L	01-05-12	14-00-00	Top	17	9			n/a
5	E86(1925)	Conc. Pt. (lbs)	L	00-02-12	00-02-12	Top		95	67		n/a
6	E75(1685)	Conc. Pt. (lbs)	L	01-07-04	01-07-04	Top		255	547		n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1733 ft-lbs	23220 ft-lbs	7.5%	45	07-10-06
Neg. Moment	-520 ft-lbs	-23220 ft-lbs	2.2%	49	01-05-04
End Shear	497 lbs	11571 lbs	4.3%	45	12-11-12
Cont. Shear	572 lbs	11571 lbs	4.9%	1	02-05-00
Total Load Deflection	L/999 (0.067")	n/a	n/a	108	07-08-06
Live Load Deflection	L/999 (0.042")	n/a	n/a	160	07-08-06
Total Neg. Defl.	2xL/1998 (-0.023")	n/a	n/a	108	00-00-00
Max Defl.	0.067"	n/a	n/a	108	07-08-06
Span / Depth	15.7				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Beam 4-1/2" x 3-1/2"	2485 lbs	29.5%	12.9%	Unspecified
B2	Wall/Plate 2-3/4" x 3-1/2"	596 lbs	10.1%	5.1%	Spruce-Pine-Fir



DESIGN NO. YAM12B85-20
STRUCTURAL
COMPONENT ONLY



Boise Cascade



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

2ND FLR FRAMING\Flush Beams\B21(12792) (Flush Beam)

Dry | 2 spans | L cant.

PASSED

August 26, 2020 09:26:19

BC CALC® Member Report

Build 7493

Job name:

Address:

City, Province, Postal Code: HAMILTON

Customer:

Code reports: CCMC 12472-R

File name: MOUNTAINASH 6

Description: 2ND FLR FRAMING\Flush Beams\B21(12792)

Specifier:

Designer: CH

Company:

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.


Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Cantilevers require sheathed bottom flanges, blocking at cantilever support and closure at ends.

Connection Diagram: Full Length of Member

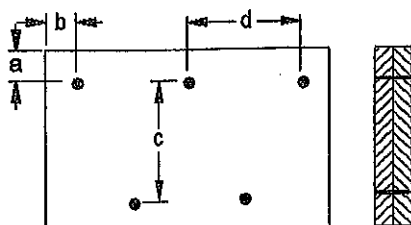

a minimum = 2"

b minimum = 3"

c = 6-1/2"

d = 8"

Connectors are:

Nails

3-1/2" ARDOX SPIRAL




OWN NO. YAM 12885-20
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,





Maximum Floor Spans

Live Load = 40 psf, Dead Load = 30 psf
Simple Spans; L/480 Deflection Limit
3/4" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-2"	13'-4"	12'-4"	15'-7"	14'-2"	13'-4"	12'-4"
	NI-40x	17'-0"	16'-0"	15'-1"	13'-11"	17'-5"	16'-1"	15'-1"	13'-11"
	NI-60	17'-2"	16'-2"	15'-5"	14'-3"	17'-6"	16'-5"	15'-5"	14'-3"
	NI-70	18'-0"	16'-11"	16'-3"	15'-6"	18'-5"	17'-3"	16'-7"	15'-6"
	NI-80	18'-3"	17'-1"	16'-5"	15'-9"	18'-8"	17'-5"	16'-9"	15'-10"
11-7/8"	NI-20	17'-10"	16'-10"	16'-0"	14'-10"	18'-6"	17'-1"	16'-0"	14'-10"
	NI-40x	19'-4"	17'-11"	17'-3"	15'-10"	19'-11"	18'-6"	17'-9"	15'-10"
	NI-60	19'-7"	18'-2"	17'-5"	16'-9"	20'-2"	18'-9"	17'-11"	17'-1"
	NI-70	20'-9"	19'-2"	18'-3"	17'-5"	21'-4"	19'-9"	18'-10"	17'-10"
	NI-80	21'-1"	19'-5"	18'-6"	17'-7"	21'-7"	20'-0"	19'-0"	18'-0"
14"	NI-90x	21'-8"	20'-0"	19'-1"	18'-0"	22'-2"	20'-6"	19'-6"	18'-6"
	NI-40x	21'-5"	19'-10"	18'-11"	17'-5"	22'-1"	20'-6"	19'-6"	17'-5"
	NI-60	21'-10"	20'-2"	19'-3"	18'-2"	22'-5"	20'-10"	19'-11"	18'-10"
	NI-70	23'-0"	21'-3"	20'-3"	19'-2"	23'-8"	21'-11"	20'-10"	19'-9"
	NI-80	23'-5"	21'-7"	20'-7"	19'-5"	24'-0"	22'-3"	21'-2"	20'-0"
16"	NI-90x	24'-1"	22'-3"	21'-2"	20'-0"	24'-8"	22'-10"	21'-9"	20'-7"
	NI-60	23'-9"	22'-0"	20'-11"	19'-10"	24'-6"	22'-9"	21'-8"	20'-6"
	NI-70	25'-1"	23'-2"	22'-0"	20'-10"	25'-9"	23'-10"	22'-9"	21'-6"
	NI-80	25'-6"	23'-6"	22'-4"	21'-2"	26'-1"	24'-2"	23'-1"	21'-10"
	NI-90x	26'-4"	24'-3"	23'-1"	21'-10"	26'-11"	24'-11"	23'-8"	22'-5"

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-2"	13'-4"	12'-4"	15'-7"	14'-2"	13'-4"	12'-4"
	NI-40x	17'-9"	16'-1"	15'-1"	13'-11"	17'-9"	16'-1"	15'-1"	13'-11"
	NI-60	18'-1"	16'-5"	15'-5"	14'-3"	18'-1"	16'-5"	15'-5"	14'-3"
	NI-70	19'-10"	17'-11"	16'-9"	15'-6"	19'-10"	17'-11"	16'-9"	15'-6"
	NI-80	20'-2"	18'-3"	17'-1"	15'-10"	20'-2"	18'-3"	17'-1"	15'-10"
11-7/8"	NI-20	18'-10"	17'-1"	16'-0"	14'-10"	18'-10"	17'-1"	16'-0"	14'-10"
	NI-40x	21'-3"	19'-3"	17'-9"	15'-10"	21'-3"	19'-3"	17'-9"	15'-10"
	NI-60	21'-9"	19'-8"	18'-5"	17'-1"	21'-9"	19'-8"	18'-5"	17'-1"
	NI-70	23'-4"	21'-5"	20'-1"	18'-6"	23'-8"	21'-5"	20'-1"	18'-6"
	NI-80	23'-7"	21'-10"	20'-5"	18'-11"	24'-1"	21'-10"	20'-5"	18'-11"
14"	NI-90x	24'-3"	22'-6"	21'-3"	19'-7"	24'-8"	22'-7"	21'-3"	19'-7"
	NI-40x	24'-2"	21'-5"	19'-6"	17'-5"	24'-2"	21'-5"	19'-6"	17'-5"
	NI-60	24'-9"	22'-5"	21'-0"	19'-6"	24'-9"	22'-5"	21'-0"	19'-6"
	NI-70	26'-1"	24'-3"	22'-9"	21'-0"	26'-8"	24'-3"	22'-9"	21'-0"
	NI-80	26'-6"	24'-7"	23'-3"	21'-6"	27'-1"	24'-10"	23'-3"	21'-6"
16"	NI-90x	27'-3"	25'-4"	24'-1"	22'-4"	27'-9"	25'-10"	24'-3"	22'-4"
	NI-60	27'-3"	24'-11"	23'-5"	21'-7"	27'-6"	24'-11"	23'-5"	21'-7"
	NI-70	28'-8"	26'-8"	25'-3"	23'-4"	29'-3"	26'-11"	25'-3"	23'-4"
	NI-80	29'-1"	27'-0"	25'-9"	23'-10"	29'-8"	27'-6"	25'-10"	23'-10"
	NI-90x	29'-11"	27'-10"	26'-6"	24'-10"	30'-6"	28'-5"	26'-11"	24'-10"

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-1274C.





Maximum Floor Spans

Live Load = 40 psf, Dead Load = 15 psf
Simple Spans, L/480 Deflection Limit
5/8" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-1"	14'-2"	13'-9"	N/A	15'-7"	14'-8"	14'-2"	N/A
	NI-40x	16'-1"	15'-2"	14'-8"	N/A	16'-7"	15'-7"	15'-1"	N/A
	NI-60	16'-3"	15'-4"	14'-10"	N/A	16'-8"	15'-9"	15'-3"	N/A
	NI-70	17'-1"	16'-1"	15'-6"	N/A	17'-5"	16'-5"	15'-10"	N/A
	NI-80	17'-3"	16'-3"	15'-8"	N/A	17'-8"	16'-7"	16'-0"	N/A
11-7/8"	NI-20	16'-11"	16'-0"	15'-5"	N/A	17'-6"	16'-6"	16'-0"	N/A
	NI-40x	18'-1"	17'-0"	16'-5"	N/A	18'-9"	17'-6"	16'-11"	N/A
	NI-60	18'-4"	17'-3"	16'-7"	N/A	19'-0"	17'-8"	17'-1"	N/A
	NI-70	19'-6"	18'-0"	17'-4"	N/A	20'-1"	18'-7"	17'-9"	N/A
	NI-80	19'-9"	18'-3"	17'-6"	N/A	20'-4"	18'-10"	17'-11"	N/A
14"	NI-90x	20'-4"	18'-9"	17'-11"	N/A	20'-10"	19'-3"	18'-5"	N/A
	NI-40x	20'-1"	18'-7"	17'-10"	N/A	20'-10"	19'-4"	18'-6"	N/A
	NI-60	20'-5"	18'-11"	18'-1"	N/A	21'-2"	19'-7"	18'-9"	N/A
	NI-70	21'-7"	20'-0"	19'-1"	N/A	22'-3"	20'-7"	19'-8"	N/A
	NI-80	21'-11"	20'-3"	19'-4"	N/A	22'-7"	20'-11"	20'-0"	N/A
16"	NI-90x	22'-7"	20'-11"	19'-11"	N/A	23'-3"	21'-6"	20'-6"	N/A
	NI-60	22'-3"	20'-8"	19'-9"	N/A	23'-1"	21'-5"	20'-6"	N/A
	NI-70	23'-6"	21'-9"	20'-9"	N/A	24'-3"	22'-5"	21'-5"	N/A
	NI-80	23'-11"	22'-1"	21'-1"	N/A	24'-8"	22'-10"	21'-9"	N/A
	NI-90x	24'-8"	22'-9"	21'-9"	N/A	25'-4"	23'-5"	22'-4"	N/A

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-8"	15'-3"	14'-5"	N/A	16'-8"	15'-3"	14'-5"	N/A
	NI-40x	17'-11"	16'-11"	16'-1"	N/A	18'-5"	17'-1"	16'-1"	N/A
	NI-60	18'-2"	17'-1"	16'-4"	N/A	18'-7"	17'-4"	16'-4"	N/A
	NI-70	19'-2"	17'-10"	17'-2"	N/A	19'-7"	18'-3"	17'-7"	N/A
	NI-80	19'-5"	18'-0"	17'-4"	N/A	19'-10"	18'-5"	17'-8"	N/A
11-7/8"	NI-20	19'-6"	18'-1"	17'-3"	N/A	19'-11"	18'-3"	17'-3"	N/A
	NI-40x	21'-0"	19'-6"	18'-8"	N/A	21'-7"	20'-2"	19'-2"	N/A
	NI-60	21'-4"	19'-9"	18'-11"	N/A	21'-11"	20'-4"	19'-6"	N/A
	NI-70	22'-6"	20'-10"	19'-11"	N/A	23'-0"	21'-5"	20'-5"	N/A
	NI-80	22'-9"	21'-1"	20'-1"	N/A	23'-3"	21'-7"	20'-8"	N/A
14"	NI-90x	23'-4"	21'-8"	20'-8"	N/A	23'-10"	22'-2"	21'-2"	N/A
	NI-40x	23'-7"	21'-11"	20'-11"	N/A	24'-3"	22'-7"	21'-7"	N/A
	NI-60	24'-0"	22'-3"	21'-3"	N/A	24'-8"	22'-11"	21'-11"	N/A
	NI-70	25'-3"	23'-4"	22'-3"	N/A	25'-10"	24'-0"	22'-11"	N/A
	NI-80	25'-7"	23'-8"	22'-7"	N/A	26'-2"	24'-4"	23'-2"	N/A
16"	NI-90x	26'-4"	24'-4"	23'-3"	N/A	26'-10"	24'-11"	23'-9"	N/A
	NI-60	26'-5"	24'-6"	23'-4"	N/A	27'-2"	25'-3"	24'-2"	N/A
	NI-70	27'-9"	25'-8"	24'-6"	N/A	28'-5"	26'-5"	25'-2"	N/A
	NI-80	28'-2"	26'-1"	24'-10"	N/A	28'-10"	26'-9"	25'-6"	N/A
	NI-90x	29'-0"	26'-10"	25'-7"	N/A	29'-7"	27'-5"	26'-2"	N/A

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of $1.50L + 1.25D$. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA Q86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.



Maximum Floor Spans

Live Load = 40 psf, Dead Load = 15 psf
Simple Spans, L/480 Deflection Limit
3/4" OSB G&N Sheathing



Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-10"	15'-0"	14'-5"	13'-5"	16'-4"	15'-5"	14'-6"	13'-5"
	NI-40x	17'-0"	16'-0"	15'-5"	14'-9"	17'-5"	16'-5"	15'-10"	15'-2"
	NI-60	17'-2"	16'-2"	15'-7"	14'-11"	17'-6"	16'-7"	15'-11"	15'-3"
	NI-70	18'-0"	16'-11"	16'-3"	15'-7"	18'-5"	17'-3"	16'-7"	15'-11"
	NI-80	18'-3"	17'-4"	16'-5"	15'-9"	18'-8"	17'-5"	16'-9"	16'-1"
11-7/8"	NI-20	17'-10"	16'-10"	16'-2"	15'-6"	18'-6"	17'-4"	16'-9"	16'-1"
	NI-40x	19'-4"	17'-11"	17'-3"	16'-6"	19'-11"	18'-6"	17'-9"	17'-0"
	NI-60	19'-7"	18'-2"	17'-5"	16'-9"	20'-2"	18'-9"	17'-11"	17'-2"
	NI-70	20'-9"	19'-2"	18'-3"	17'-5"	21'-4"	19'-9"	18'-10"	17'-10"
	NI-80	21'-1"	19'-5"	18'-6"	17'-7"	21'-7"	20'-0"	19'-0"	18'-0"
14"	NI-90x	21'-8"	20'-0"	19'-1"	18'-0"	22'-2"	20'-6"	19'-6"	18'-6"
	NI-40x	21'-5"	19'-10"	18'-11"	17'-11"	22'-1"	20'-6"	19'-7"	18'-7"
	NI-60	21'-10"	20'-2"	19'-3"	18'-2"	22'-5"	20'-10"	19'-11"	18'-10"
	NI-70	23'-0"	21'-3"	20'-3"	19'-2"	23'-8"	21'-11"	20'-10"	19'-9"
	NI-80	23'-5"	21'-7"	20'-7"	19'-5"	24'-0"	22'-3"	21'-2"	20'-0"
16"	NI-90x	24'-1"	22'-3"	21'-2"	20'-0"	24'-8"	22'-10"	21'-9"	20'-7"
	NI-60	23'-9"	22'-0"	20'-11"	19'-10"	24'-6"	22'-9"	21'-8"	20'-6"
	NI-70	25'-1"	23'-2"	22'-0"	20'-10"	25'-9"	23'-10"	22'-9"	21'-6"
	NI-80	25'-6"	23'-6"	22'-4"	21'-2"	26'-1"	24'-2"	23'-1"	21'-10"
	NI-90x	26'-4"	24'-3"	23'-1"	21'-10"	26'-11"	24'-11"	23'-8"	22'-5"

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-10"	15'-5"	14'-6"	13'-5"	16'-10"	15'-5"	14'-6"	13'-5"
	NI-40x	18'-8"	17'-2"	16'-3"	15'-2"	18'-10"	17'-2"	16'-3"	15'-2"
	NI-60	18'-11"	17'-6"	16'-6"	15'-5"	19'-2"	17'-6"	16'-6"	15'-5"
	NI-70	20'-0"	18'-7"	17'-9"	16'-7"	20'-5"	18'-11"	17'-10"	16'-7"
	NI-80	20'-3"	18'-10"	17'-11"	16'-10"	20'-8"	19'-3"	18'-2"	16'-10"
11-7/8"	NI-20	20'-1"	18'-5"	17'-5"	16'-2"	20'-1"	18'-5"	17'-5"	16'-2"
	NI-40x	21'-10"	20'-4"	19'-4"	17'-8"	22'-5"	20'-6"	19'-4"	17'-8"
	NI-60	22'-1"	20'-7"	19'-7"	18'-4"	22'-8"	20'-10"	19'-8"	18'-4"
	NI-70	23'-4"	21'-8"	20'-8"	19'-7"	23'-10"	22'-3"	21'-2"	19'-9"
	NI-80	23'-7"	21'-11"	20'-11"	19'-9"	24'-1"	22'-6"	21'-5"	20'-0"
14"	NI-90x	24'-3"	22'-6"	21'-6"	20'-4"	24'-8"	23'-0"	22'-0"	20'-9"
	NI-40x	24'-5"	22'-9"	21'-8"	19'-5"	25'-1"	23'-2"	21'-9"	19'-5"
	NI-60	24'-10"	23'-1"	22'-0"	20'-10"	25'-6"	23'-8"	22'-4"	20'-10"
	NI-70	26'-1"	24'-3"	23'-2"	21'-10"	26'-8"	24'-11"	23'-9"	22'-4"
	NI-80	26'-6"	24'-7"	23'-5"	22'-2"	27'-1"	25'-3"	24'-1"	22'-9"
16"	NI-90x	27'-3"	25'-4"	24'-1"	22'-9"	27'-9"	25'-11"	24'-8"	23'-4"
	NI-60	27'-3"	25'-5"	24'-2"	22'-10"	28'-0"	26'-2"	24'-9"	23'-1"
	NI-70	28'-8"	26'-8"	25'-4"	23'-11"	29'-3"	27'-4"	26'-1"	24'-8"
	NI-80	29'-1"	27'-0"	25'-9"	24'-4"	29'-8"	27'-9"	26'-5"	25'-0"
	NI-90x	29'-11"	27'-10"	26'-6"	25'-0"	30'-6"	28'-5"	27'-2"	25'-8"

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-1274C.

Maximum Floor Spans

Live Load = 40 psf, Dead Load = 30 psf
Simple Spans, L/480 Deflection Limit
5/8" OSB G&N Sheathing





Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-1"	14'-1"	13'-3"	N/A	15'-7"	14'-1"	13'-3"	N/A
	NI-40x	16'-1"	15'-2"	14'-8"	N/A	16'-7"	15'-7"	15'-1"	N/A
	NI-60	16'-3"	15'-4"	14'-10"	N/A	16'-8"	15'-9"	15'-3"	N/A
	NI-70	17'-1"	16'-1"	15'-6"	N/A	17'-5"	16'-5"	15'-10"	N/A
	NI-80	17'-3"	16'-3"	15'-8"	N/A	17'-8"	16'-7"	16'-0"	N/A
11-7/8"	NI-20	16'-11"	16'-0"	15'-5"	N/A	17'-6"	16'-6"	16'-0"	N/A
	NI-40x	18'-1"	17'-0"	16'-5"	N/A	18'-9"	17'-6"	16'-11"	N/A
	NI-60	18'-4"	17'-3"	16'-7"	N/A	19'-0"	17'-8"	17'-1"	N/A
	NI-70	19'-6"	18'-0"	17'-4"	N/A	20'-1"	18'-7"	17'-9"	N/A
	NI-80	19'-9"	18'-3"	17'-6"	N/A	20'-4"	18'-10"	17'-11"	N/A
14"	NI-90x	20'-4"	18'-9"	17'-11"	N/A	20'-10"	19'-3"	18'-5"	N/A
	NI-40x	20'-1"	18'-7"	17'-10"	N/A	20'-10"	19'-4"	18'-6"	N/A
	NI-60	20'-5"	18'-11"	18'-1"	N/A	21'-2"	19'-7"	18'-9"	N/A
	NI-70	21'-7"	20'-0"	19'-1"	N/A	22'-3"	20'-7"	19'-8"	N/A
	NI-80	21'-11"	20'-3"	19'-4"	N/A	22'-7"	20'-11"	20'-0"	N/A
16"	NI-90x	22'-7"	20'-11"	19'-11"	N/A	23'-3"	21'-6"	20'-6"	N/A
	NI-60	22'-3"	20'-8"	19'-9"	N/A	23'-1"	21'-5"	20'-6"	N/A
	NI-70	23'-6"	21'-9"	20'-9"	N/A	24'-3"	22'-5"	21'-5"	N/A
	NI-80	23'-11"	22'-1"	21'-1"	N/A	24'-8"	22'-10"	21'-9"	N/A
	NI-90x	24'-8"	22'-9"	21'-9"	N/A	25'-4"	23'-5"	22'-4"	N/A

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-1"	13'-3"	N/A	15'-7"	14'-1"	13'-3"	N/A
	NI-40x	17'-9"	16'-1"	15'-1"	N/A	17'-9"	16'-1"	15'-1"	N/A
	NI-60	18'-1"	16'-4"	15'-4"	N/A	18'-1"	16'-4"	15'-4"	N/A
	NI-70	19'-2"	17'-10"	16'-9"	N/A	19'-7"	17'-10"	16'-9"	N/A
	NI-80	19'-5"	18'-0"	17'-1"	N/A	19'-10"	18'-3"	17'-1"	N/A
11-7/8"	NI-20	18'-9"	17'-0"	16'-0"	N/A	18'-9"	17'-0"	16'-0"	N/A
	NI-40x	21'-0"	19'-3"	17'-9"	N/A	21'-3"	19'-3"	17'-9"	N/A
	NI-60	21'-4"	19'-8"	18'-5"	N/A	21'-8"	19'-8"	18'-5"	N/A
	NI-70	22'-6"	20'-10"	19'-11"	N/A	23'-0"	21'-4"	20'-0"	N/A
	NI-80	22'-9"	21'-1"	20'-1"	N/A	23'-3"	21'-7"	20'-5"	N/A
14"	NI-90x	23'-4"	21'-8"	20'-8"	N/A	23'-10"	22'-2"	21'-2"	N/A
	NI-40x	23'-7"	21'-5"	19'-6"	N/A	24'-1"	21'-5"	19'-6"	N/A
	NI-60	24'-0"	22'-3"	21'-0"	N/A	24'-8"	22'-5"	21'-0"	N/A
	NI-70	25'-3"	23'-4"	22'-3"	N/A	25'-10"	24'-0"	22'-9"	N/A
	NI-80	25'-7"	23'-8"	22'-7"	N/A	26'-2"	24'-4"	23'-2"	N/A
16"	NI-90x	26'-4"	24'-4"	23'-3"	N/A	26'-10"	24'-11"	23'-9"	N/A
	NI-60	26'-5"	24'-6"	23'-4"	N/A	27'-2"	24'-10"	23'-4"	N/A
	NI-70	27'-9"	25'-8"	24'-6"	N/A	28'-5"	26'-5"	25'-2"	N/A
	NI-80	28'-2"	26'-1"	24'-10"	N/A	28'-10"	26'-9"	25'-6"	N/A
	NI-90x	29'-0"	26'-10"	25'-7"	N/A	29'-7"	27'-5"	26'-2"	N/A

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.

1w-1

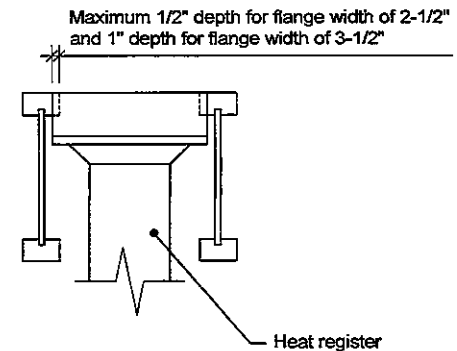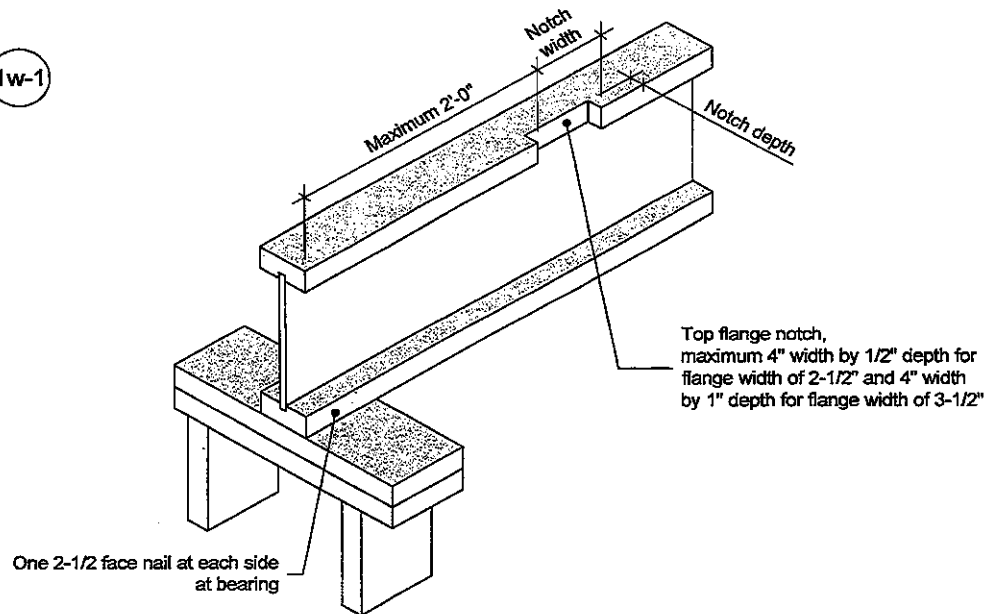

Notes:

1. Blocking required at bearing for lateral support, not shown for clarity.
2. The maximum dimensions for a notch on the side of the top flange are 4-inch width by 1/2-inch depth for flange width of 2-1/2 inches, and 4-inch width by 1-inch depth for flange width of 3-1/2 inches.
3. This detail applies to simple-span joists and multiple-span joists where the notch is located at the end half-span.
4. For other applications, contact Nordic Structures.

This document supersedes all previous versions. If the document has been in effect for more than one year, consult nordic.ca or contact Nordic Structures.

All nails shown in the details are assumed to be common nails unless otherwise noted. Nails shall have a diameter not less than 0.128 inch for 2-1/2-inch nails, or 0.144 inch for 3-inch nails. Individual components not shown to scale for clarity.

**NORDIC
STRUCTURES**

T 514-871-8526
1 866 817-3418
nordic.ca

TITLE

Notch in I-joist for Heat Register

CATEGORY

I-joist - Typical Floor Framing and Construction Details

DOCUMENT

-

DATE

2018-04-10

NUMBER


1w-1

Allowance for Piping (Installation Notes)

The floor layouts have usually not been checked for heating and/or plumbing interference. On-site adjustment of joists of up to 3 inches is permitted to avoid interferences. When moving a joist, the subfloor thickness shall be checked with code requirements when the joist spacing exceeds 19.2 inches. Except for cutting to length, I-joist flanges should never be cut, drilled, or notched.

Installation of Nordic I-joists shall be as per *Nordic Joist Installation Guide for Residential Floors*. Refer to Tables 1 and 2 for maximum web hole and duct chase openings, respectively. These tables are based on the I-joists being used at their maximum spans. The minimum distance given may be reduced for shorter spans; contact your distributor for additional information.

The detail below shows the 3-inch allowance for piping. Every third joist may be shifted up to 3 inches to avoid heating/plumbing interference. For other applications, please contact your distributor.

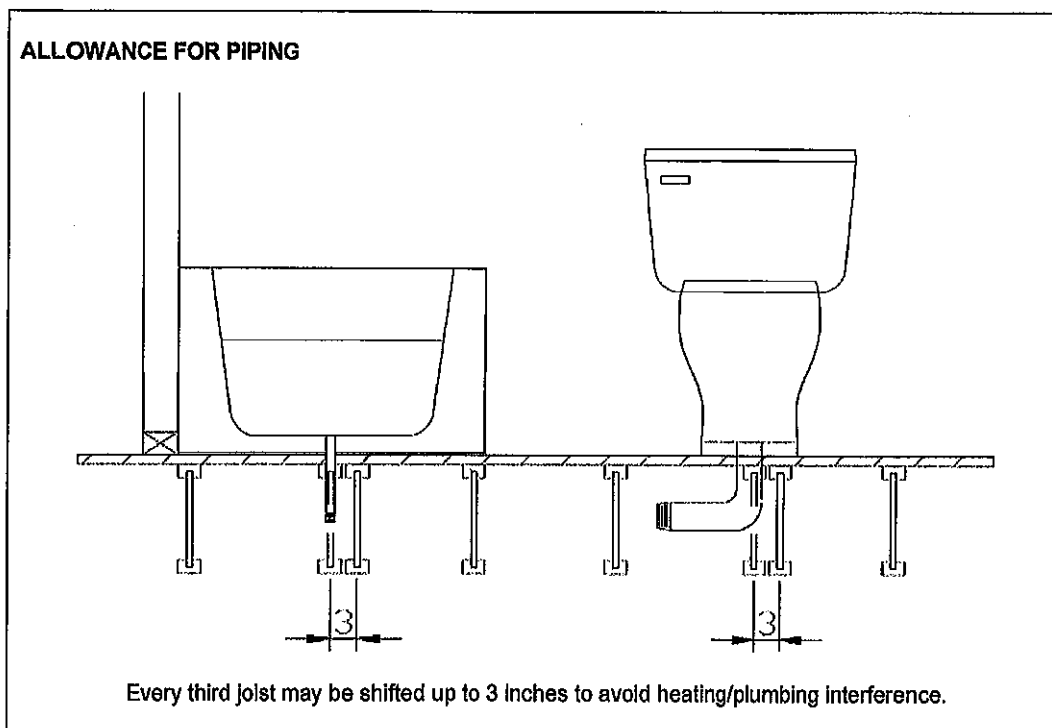

Revised April 12, 2012