


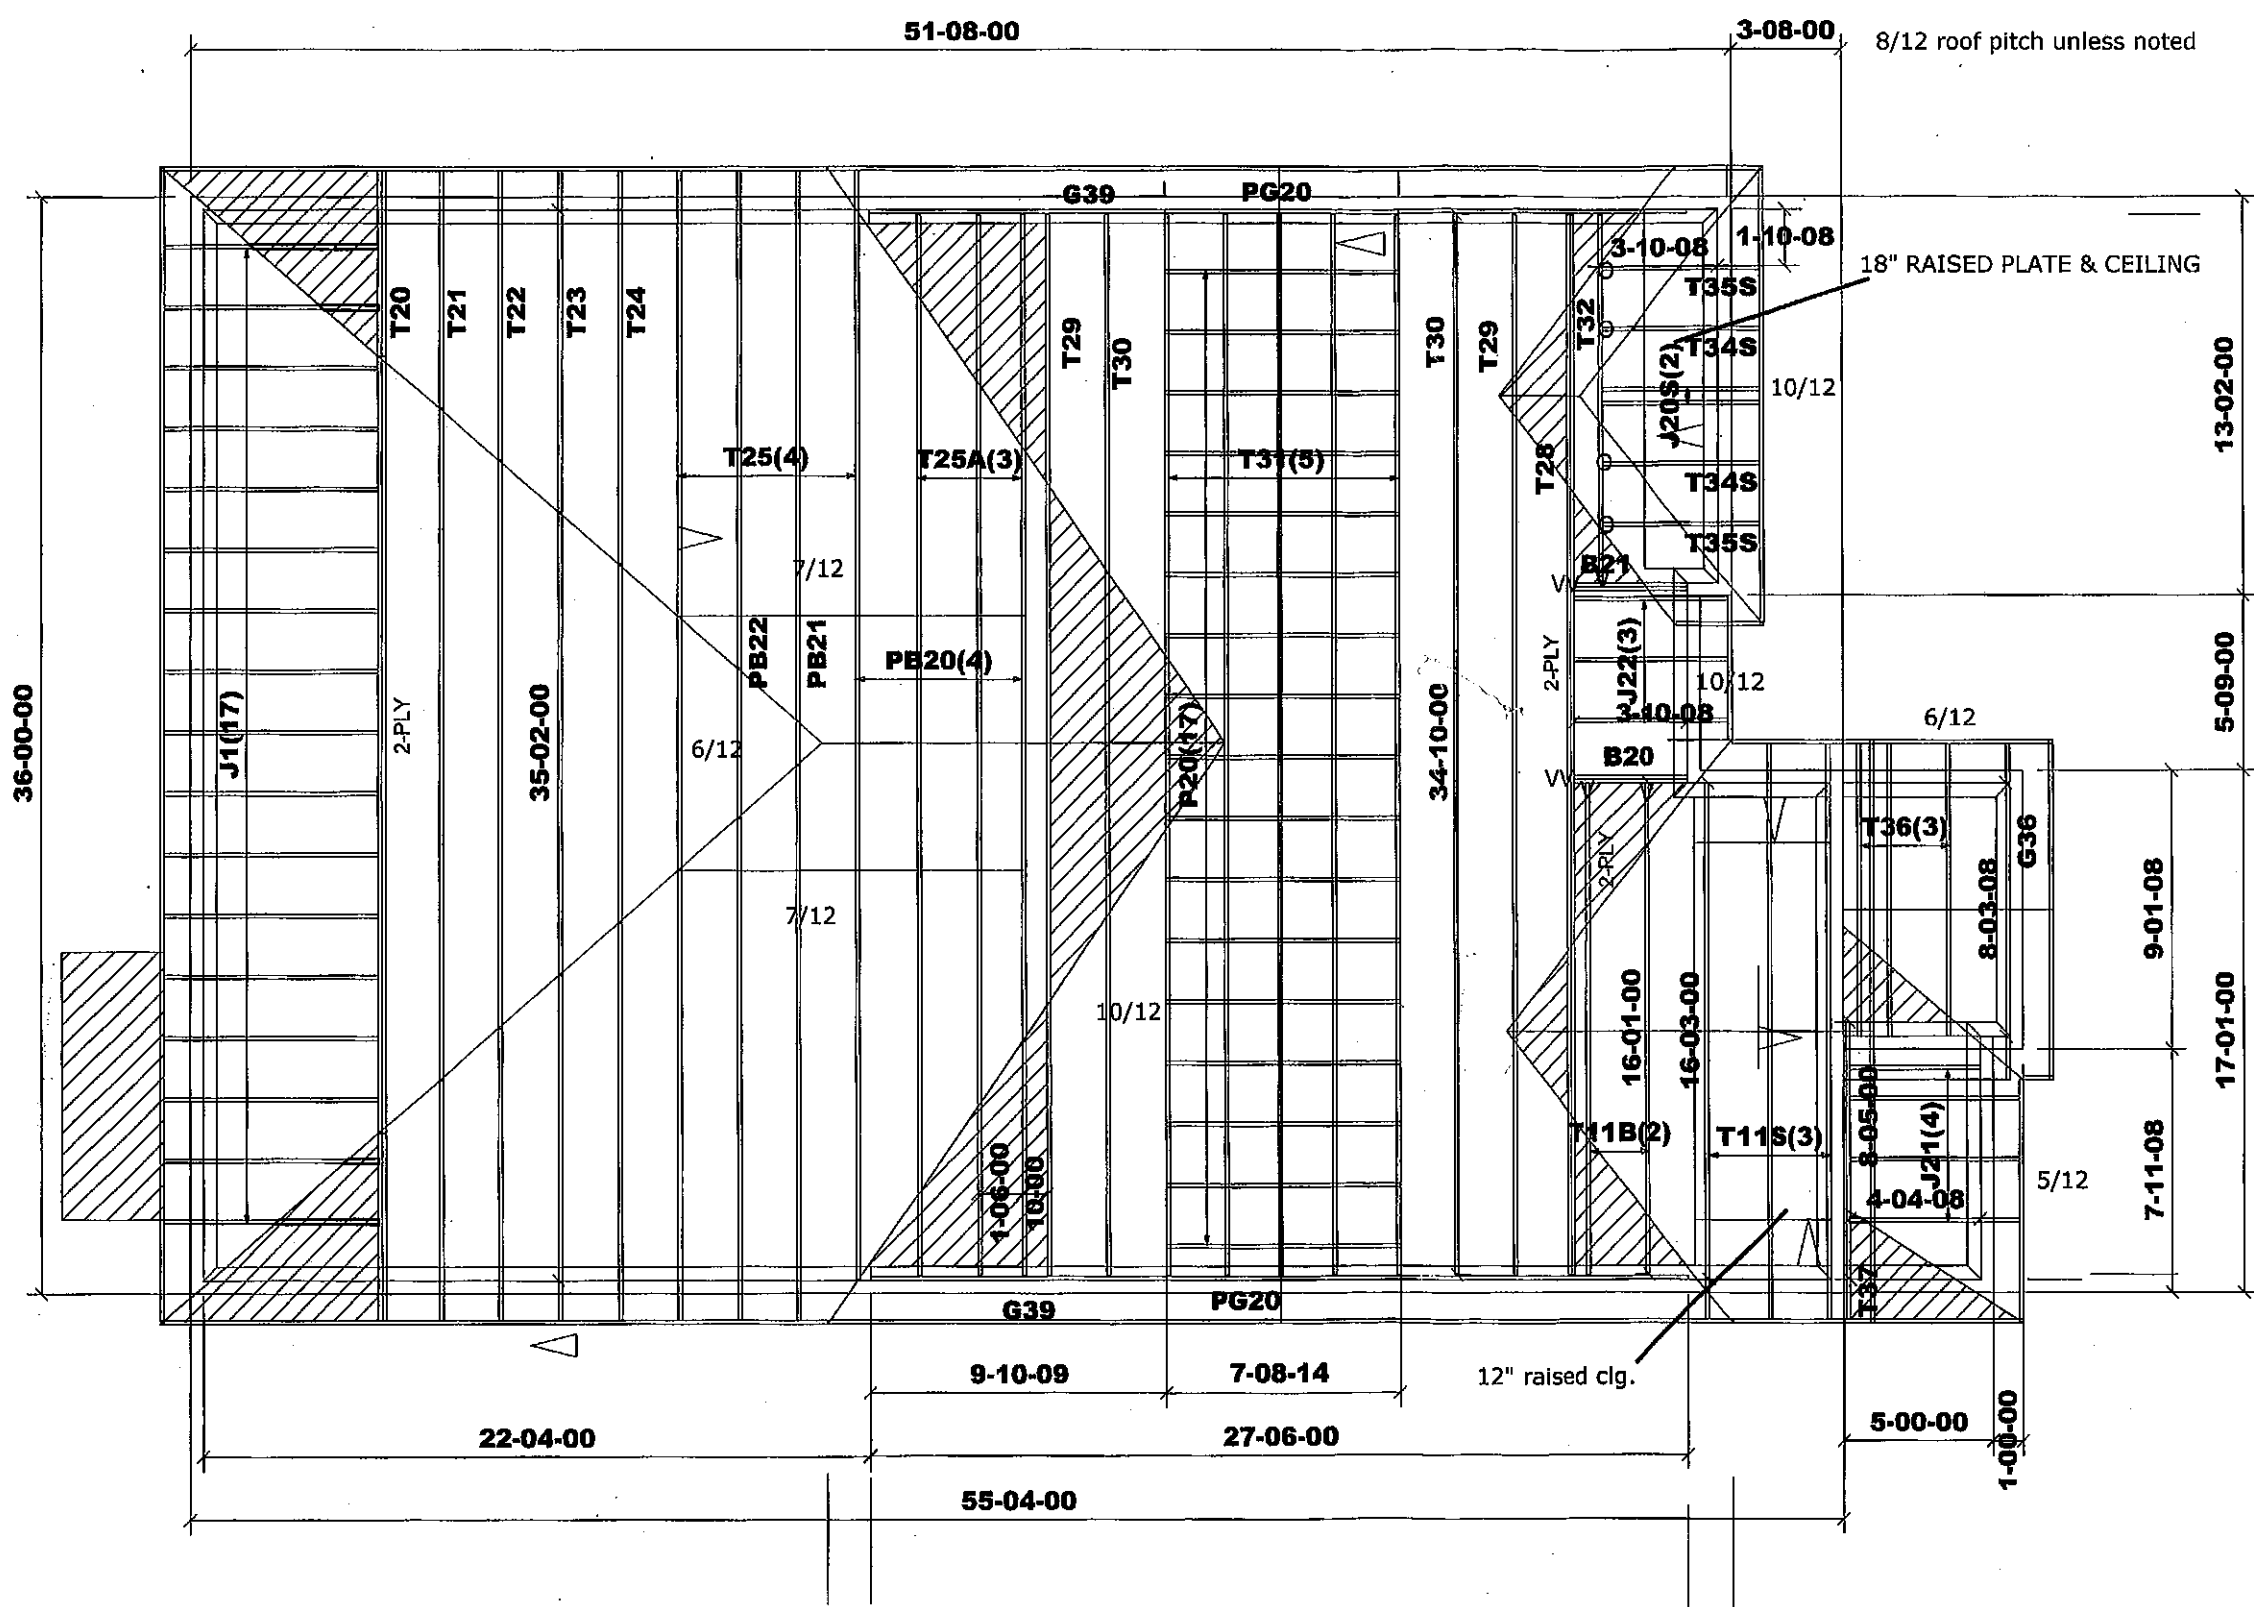

ASPHALT SHINGLES
 FINISHED OVERHANG: 12"
 2x6 EXTERIOR WALLS
 2x6 FASCIA BOARD
 HEEL: R.T.M.C.

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.


DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: RESIDENTIAL | PART: 9
 Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
 TCSL = 25.6 psf
 TCDL = 6.0 psf
 BCLL = 0.0 psf
 BCDL = 7.4 psf

HARDWARE:
 LUS24 - (O)
 LJS26DS - (V)
 HGUS26-2 - (XX)
 LUS26-2-(VV)

BEAMS:
 B20= B21 =
 2 - 2x10 SPF #2

 DENOTES: CONVENTIONAL FRAMING OF HAMILTON Building Division

Permit No. 21-107140
 THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
 THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
 These drawings and/or specifications have been reviewed by  DATE APR 20 2021

M13138



Job Track: 51225
 Plan Log: 202419
 Layout ID: 408223

Builder / Location: GREEN PARK HOMES / WATERDOWN
 Project: RUSSELL GARDENS PH.3
 Date: 2020-04-28 Sales: Mario DiCano Designer: JG

Model / Elevation: MOUNTAINASH 6/2-STD OR OPT.5 BR

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

LST 264

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 6
 Lot #: 264
 Elevation: 2-STD OR OPT.5 BR

Job Track: 51225
 PlanLog: 202419
 Layout ID: 408223
 Ref #
 Page: 1 of 3
 Date: 04-28-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	T11B Common	8 /12	16-01-00	6-09-13	2 x 4		1-06-02 1-04-13	137.47 88.33		
	3	T11S Roof Special	8 /12 8 /12	16-03-00	6-09-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	201.4 133.00		
	1 2-ply	T20 Hip Girder	7 /12	35-02-00	4-01-04	2 x 6	1-03-08 1-03-08	1-03-07 1-03-07	359.46 218.00		
	1	T21 Hip	7 /12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-03-07 1-03-07	142.49 89.50		
	1	T22 Hip	7 /12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-03-07 1-03-07	146.47 93.50		
	1	T23 Hip	7 /12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-03-07 1-03-07	144.95 91.17		
	1	T24 Hip	7 /12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-03-07 1-03-07	151.12 95.67		
	4	T25 Hip	7 /12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-03-07 1-03-07	631.9 399.33		
	3	T25A Piggyback Base	7 /12	34-10-00	9-01-04	2 x 4		1-04-09 1-04-09	461.61 286.50		
	1 2-ply	T28 Flat Girder	0 /12	34-10-00	4-10-07	2 x 6		4-10-07 4-10-07	366.38 214.67		
	2	T29 Flat	0 /12	34-10-00	6-06-07	2 x 4		6-06-07 6-06-07	313.97 193.33		
	2	T30 Flat	0 /12	34-10-00	8-02-07	2 x 4		8-02-07 8-02-07	358.85 220.00		
	5	T31 Flat	0 /12	34-10-00	9-10-07	2 x 4		9-10-07 9-10-07	980.54 600.00		
	1	T32 Hip Girder	8 /12	12-02-00	6-04-07	2 x 4 2 x 6		3-00-02 2-10-13	66.45 43.67		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 6
 Lot #: 264
 Elevation: 2-STD OR OPT.5 BR

Job Track: 51225
 PlanLog: 202419
 Layout ID: 408223
 Ref #
 Page: 2 of 3
 Date: 04-28-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	T34S Half Hip	10 / 12	3-10-08	5-05-13	2 x 4	1-03-08	1-07-11 5-05-13	63.75 44.33		
	2	T35S Half Hip	10 / 12	3-10-08	4-01-13	2 x 4	1-03-08	1-07-11 4-01-13	57.2 41.00		
	3	T36 Common	6 / 12	8-03-08	3-00-09	2 x 4	1-03-08 1-03-08	5-07 5-07	79.81 53.00		
	1	G36 GABLE	6 / 12	8-03-08	3-01-05	2 x 4	1-03-08 1-05-00	5-07 5-07	28.93 17.33		
	1	T37 Half Hip Girder	8 / 12	8-05-00	2-08-03	2 x 4 2 x 6	1-03-08	8-05 2-01-15	38.62 26.00		
	2	G39 GABLE	10 / 12	27-06-00	9-10-07	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	303.3 183.33		
	17	P20 Common	10 / 12	7-08-14	3-02-12	2 x 4		0-01 0-01	383.26 229.50		
	4	PB20 Piggyback	7 / 12	8-04-05	2-05-04	2 x 4			80.17 49.33		
	1	PB22 Piggyback	7 / 12	8-04-05	1-00-00	2 x 4			18.28 11.67		
	1	PB21 Piggyback	7 / 12	8-04-05	2-00-00	2 x 4			21.88 14.33		
	2	PG20 GABLE	10 / 12	7-09-00	3-02-12	2 x 4			44.53 30.33		
	17	J1 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	285.51 181.33		
	2	J20S Jack-Open	10 / 12	3-10-08	6-04-07	2 x 4	1-03-08	1-07-11 6-04-07	65.13 43.33		
	4	J21 Jack-Open	5 / 12	4-04-08	2-08-02	2 x 4	1-03-08	4-01 2-01-15	48.51 32.00		

 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: MOUNTAINASH 6 Lot #: 264 Elevation: 2-STD OR OPT.5 BR	Job Track: 51225 PlanLog: 202419 Layout ID: 408223 Ref # Page: 3 of 3 Date: 04-28-2020 Designer: Sales Rep: Mario DiCanó

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	3	J22 Jack-Open	10 /12	3-10-08	4-10-07	2 x 4	1-03-08	1-07-11 4-10-07	45.68 29.00		

TOTAL # TRUSS= 92 TOTAL BFT OF ALL TRUSSES= 3762.48 BFT. TOTAL WEIGHT OF ALL TRSSES 6003.41 LBS

HARDWARE


QTY	TYPE	MODEL	LENGTH
3	Hardware	LJS26DS	
4	Hardware	LUS24	
2	Hardware	LUS26-2	

TOTAL NUMBER OF
ITEMS= 9


JOB NAME 408222	TRUSS NAME T1	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.		Version 8.310 S Oct 29 2019 M&T Industries, Inc. Tue Apr 28 09:00:04 2020 Page 1			

Tamareck Roof Truss, Burlington

ID:DMCubINVR6TsFoe31v6I zns1I-Jm9J1AhZ12g2EEminZsEz3HTH?mEdCAUuvczMFI



Scale = 1/8" = 1'-0"

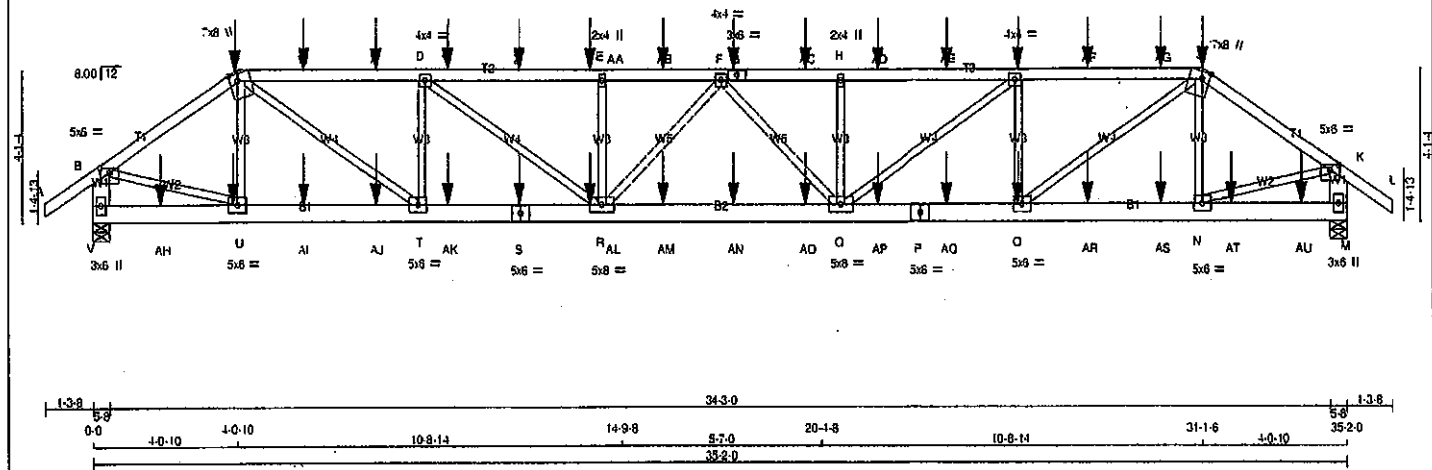

TOTAL WEIGHT = 2 X 181 = 323 lb

LUMBER	N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS	SIZE	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
C - G	2x4	DRY	No.2	SPF
G - J	2x4	DRY	No.2	SPF
J - L	2x4	DRY	No.2	SPF
V - B	2x8	DRY	No.2	SPF
M - K	2x8	DRY	No.2	SPF
V - S	2x8	DRY	No.2	SPF
S - P	2x8	DRY	No.2	SPF
P - M	2x8	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 1	12	SIDE(61.0)
C - G 1	12	SIDE(61.0)
G - J 1	12	SIDE(61.0)
J - L 1	12	SIDE(61.0)
V - B 2	12	TOP
M - K 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
V - S 2	12	SIDE(183.1)
S - P 2	12	SIDE(183.1)
P - M 2	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
V	3393 0	3393 0	0	5-8	5-8
M	3342 0	3342 0	0	5-8	5-8

UNFACTORED REACTIONS		1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
V	2397	1585 0	0 0
M	2383	1555 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.11 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING		TOTAL LOAD CASES: (4)	
CHORDS	MAX. FACTORED	FACTORED	WEBS
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED
FR-TO	FROM TO	CS1 (LC)	MAX. FACTORED
A-B	0 35	-91.8 -91.8 0.07 (1)	10.00
B-C	-4024 0	-91.8 -91.8 0.22 (1)	4.65
C-W	-8074 0	-91.8 -91.8 0.53 (1)	3.51
W-X	-8074 0	-91.8 -91.8 0.53 (1)	3.51
X-D	-8074 0	-91.8 -91.8 0.53 (1)	3.51
D-Y	-7423 0	-91.8 -91.8 0.53 (1)	3.11
Y-Z	-7423 0	-91.8 -91.8 0.53 (1)	3.11
Z-AA	-7423 0	-91.8 -91.8 0.53 (1)	3.11
AA-E	-7423 0	-91.8 -91.8 0.53 (1)	3.11
E-AB	-7423 0	-91.8 -91.8 0.53 (1)	3.11
AB-F	-7423 0	-91.8 -91.8 0.53 (1)	3.11
F-G	-7410 0	-91.8 -91.8 0.53 (1)	3.11
G-AC	-7410 0	-91.8 -91.8 0.53 (1)	3.11
AC-H	-7410 0	-91.8 -91.8 0.53 (1)	3.11
H-AD	-7410 0	-91.8 -91.8 0.53 (1)	3.11
AD-AE	-7410 0	-91.8 -91.8 0.53 (1)	3.11
AE-I	-7410 0	-91.8 -91.8 0.53 (1)	3.11
I-AF	-6040 0	-91.8 -91.8 0.51 (1)	3.55
AF-AG	-6040 0	-91.8 -91.8 0.51 (1)	3.55
AG-J	-6040 0	-91.8 -91.8 0.51 (1)	3.55
J-K	-3948 0	-91.8 -91.8 0.22 (1)	4.58
K-L	0 35	-91.8 -91.8 0.07 (1)	10.00
V-B	-3355 0	0.0 0.0 0.12 (1)	7.60
M-K	-3298 0	0.0 0.0 0.12 (1)	7.64

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17')
CALCULATED VERT. DEFL. (LL) = L/999 (0.23')
ALLOWABLE DEFL. (TL) = L/360 (1.17')
CALCULATED VERT. DEFL. (TL) = L/970 (0.44')

CS1: TC=0.63(1.00) (D-E); BC=0.57 1.00 (O-R); WB=0.43(1.00) (B-U); SS=0.19(1.00) (C-D)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE REELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (I) (INPUT = 0.90)
JSI METAL = 0.58 (I) (INPUT = 1.00)

CONTINUED ON PAGE 2



Structural component only
DWG# T-2007602 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T1	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:00:04 2020 Page 2

ID:DMCubINVR6TsIFoe31v6I zns1I-Jm9J91AhZl22o2EEemNZsEz3HTH?mEdCAUuvzMFH

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.50	3.00
C	TTWW-m	MT20	7.0	8.0	Edge	2.50
D, F, I						
D	TMVW-l	MT20	4.0	4.0		
E	TMVW-w	MT20	2.0	4.0		
G	TS-l	MT20	3.0	6.0		
H	TMVW-w	MT20	2.0	4.0		
J	TTWW-m	MT20	7.0	8.0	Edge	2.50
K	TMVW-p	MT20	5.0	6.0	1.50	3.00
M	BMVl-p	MT20	3.0	6.0		
N, O, T, U						
N	BMVW-l	MT20	5.0	6.0		
P	BS-l	MT20	5.0	6.0		
Q	BMVW-l	MT20	5.0	6.0		
R	BMVW-l	MT20	5.0	6.0		
S	BS-l	MT20	5.0	6.0		
V	BMVl-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. UNBRAC. LENGTH	MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1
FR-TO		FROM	TO		FR-TO		
AR-AS	0 3261	-18.5	-18.5 0.25 (1)	10.00			
AS-N	0 3281	-18.5	-18.5 0.25 (1)	10.00			
N-AT	0 0	-18.5	-18.5 0.04 (4)	10.00			
AT-AU	0 0	-18.5	-18.5 0.04 (4)	10.00			
AU-M	0 0	-18.5	-18.5 0.04 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-10	-49	-55	---	FRONT	VERT	DEAD	---	C1
C	4-0-10	-117	-117	---	FRONT	VERT	TOTAL	---	C1
C	4-0-10	-254	-254	---	FRONT	VERT	SNOW	---	C1
G	17-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
I	25-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
J	31-1-6	-49	-55	---	FRONT	VERT	DEAD	---	C1
J	31-1-6	-254	-254	---	FRONT	VERT	SNOW	---	C1
O	25-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
S	11-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
U	3-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
W	5-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	19-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	21-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	23-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	27-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AG	29-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AH	1-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AI	5-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AJ	7-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AK	9-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AL	13-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AM	15-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AN	17-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AO	19-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AP	21-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AQ	23-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AR	27-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AS	29-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AT	31-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AU	33-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007602 7/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T1Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MitTek Industries, Inc. Tue Apr 28 09:00:05 2020 Page 2
ID:DMCubINVR6TslFos31v6I zns1I-nvIhMNBjKcAvHCpOKTuoORVWDosnKApnRqDRR2zMFis


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TTWW-m	MT20	6.0	9.0	1.75	3.50
D	TMVW-l	MT20	4.0	6.0		
E	TMW-w	MT20	2.0	4.0		
F	TMVW-l	MT20	4.0	4.0		
G	TS-l	MT20	3.0	6.0		
H	TMW-w	MT20	2.0	4.0		
I	TMVW-l	MT20	4.0	8.0		
J	TTWW-m	MT20	6.0	9.0	1.75	3.50
K	TMVW-p	MT20	5.0	8.0	Edge	
M	BMVl-p	MT20	3.0	8.0		
N	BMVW-l	MT20	5.0	8.0	2.50	2.25
O	BMVW-l	MT20	6.0	9.0	4.50	2.50
P	BS-l	MT20	5.0	8.0		
Q	BMVWW-l	MT20	5.0	8.0		
R	BMVWW-l	MT20	5.0	8.0		
S	BS-l	MT20	5.0	6.0		
T	BMVW-l	MT20	6.0	9.0	4.50	2.50
U	BMVW-l	MT20	5.0	6.0	2.50	2.25
V	BMVl-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.


CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

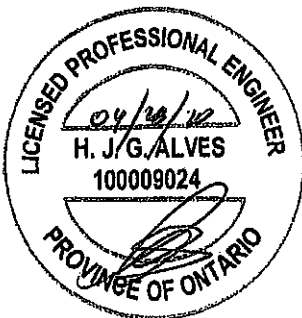

Structural component only
DWG# T-2007603 7/2

JOB NAME 408222	TRUSS NAME T2	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:00:06 2020 Page 1	
ID:DMCubINVR8TstF0e31v6l zns11-F8H4ajCx5wlmvMOcuAP1x12LCGy5TgYwUz? UzMPId				35-2.0 38-5.8 1-3.8	
-1-3.8 0.0 5-6-10 5-6-10 6-0-13 11-7-7 5-11-9 17-7-0 5-11-9 23-6-9 6-0-13 29-7-4 5-6-10 35-2.0				Scale = 1:57.6	

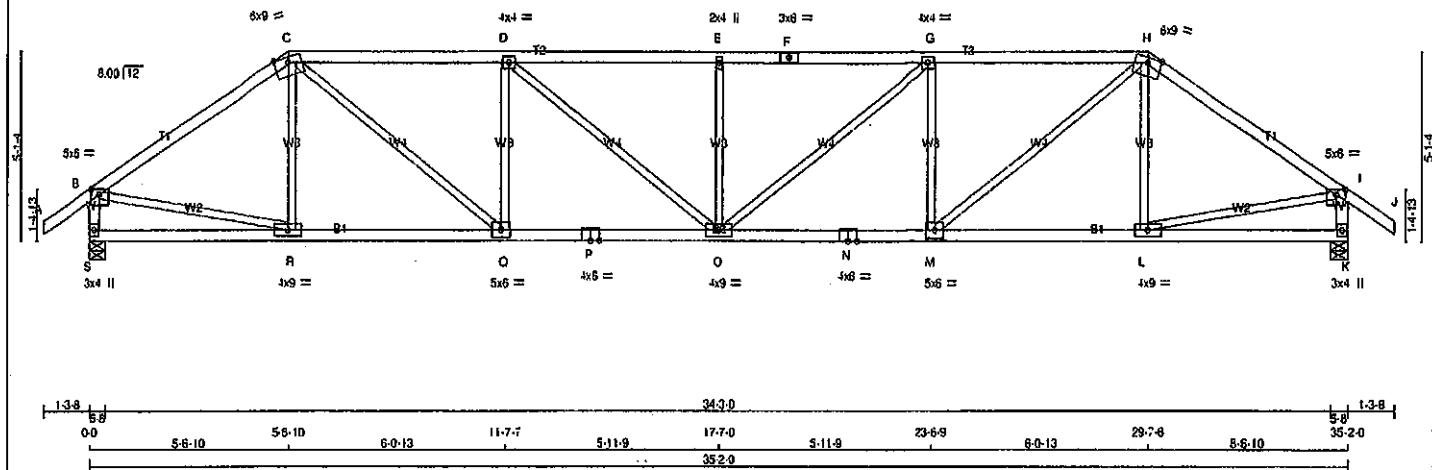

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - F	2x4	DRY No.2	SPF
F - H	2x4	DRY No.2	SPF
H - J	2x4	DRY No.2	SPF
J - L	2x4	DRY No.2	SPF
L - M	2x4	DRY No.2	SPF
M - N	2x4	DRY No.2	SPF
N - K	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW-p	MT20	5.0	6.0 1.75 2.75
C	TTWW-m	MT20	6.0	9.0 Edge
D	TMVW-i	MT20	4.0	4.0
E	TMVW-w	MT20	2.0	4.0
F	TS-I	MT20	3.0	6.0
G	TMVW-i	MT20	4.0	4.0
H	TTWW-m	MT20	6.0	9.0 Edge
I	TMVW-p	MT20	5.0	6.0 1.75 2.75
K	BMVW-i	MT20	3.0	4.0
L	BMVW-i	MT20	4.0	9.0
M	BMVW-i	MT20	5.0	6.0
N	SS-I	MT20	4.0	6.0
O	BMVW-w	MT20	4.0	9.0
P	SS-I	MT20	4.0	6.0
Q	BMVW-i	MT20	5.0	6.0
R	BMVW-i	MT20	4.0	9.0
S	BMVW-i	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
S	2065	0	2085	0	5-8
K	2065	0	2085	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	1458	970	0	0	0	0	488	0
K	1458	970	0	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.97 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED MAX. CS (LC)
FR-TO	FROM TO	FR-TO	FROM TO
A-B	0 35	-91.8 -91.8 0.12 (1)	10.00 R-C -243 10 0.09 (1)
B-C	-2298 0	-91.8 -91.8 0.70 (1)	3.78 C-D 0 1670 0.38 (1)
C-D	-3213 0	-91.8 -91.8 0.80 (1)	3.19 D-E -929 0 0.38 (1)
D-E	-3594 0	-91.8 -91.8 0.88 (1)	2.97 E-F 0 490 0.19 (1)
E-F	-3594 0	-91.8 -91.8 0.88 (1)	2.97 F-G 0 490 0.19 (1)
F-G	-3594 0	-91.8 -91.8 0.88 (1)	2.97 G-H 0 490 0.19 (1)
G-H	-3213 0	-91.8 -91.8 0.80 (1)	3.19 H-I -929 0 0.38 (1)
H-I	-2298 0	-91.8 -91.8 0.70 (1)	3.78 I-J 0 1670 0.38 (1)
I-J	0 35	-91.8 -91.8 0.12 (1)	10.00 J-K -243 10 0.09 (1)
S-B	-2023 0	0.0 0.0 0.21 (1)	5.94 B-R 0 1943 0.44 (1)
K-I	-2023 0	0.0 0.0 0.21 (1)	5.94 I-L 0 1943 0.44 (1)
S-R	0 0	-18.5 -18.5 0.15 (4)	10.00
R-Q	0 1903	-18.5 -18.5 0.39 (1)	10.00
Q-P	0 3213	-18.5 -18.5 0.58 (1)	10.00
P-O	0 3213	-18.5 -18.5 0.58 (1)	10.00
O-N	0 3213	-18.5 -18.5 0.58 (1)	10.00
N-M	0 3213	-18.5 -18.5 0.58 (1)	10.00
M-L	0 1903	-18.5 -18.5 0.39 (1)	10.00
L-K	0 0	-18.5 -18.5 0.15 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/989 (0.21")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/989 (0.39")

CSK: TC=0.86(1.00) (D-E:1), BC=0.58(1.00) (M-O:1), WB=0.44(1.00) (I-L:1), SS=0.26(1.00) (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1687 788	1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (I) (INPUT = 0.90)
JSI METAL = 0.74 (I) (INPUT = 1.00)



Structural component only
DWG# T-2007604


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T3	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310.3 Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:00:08 2020 Page 1

ID:DMCubINVR6TstFoe31v6l_zns11-F8H4ajCx5wlmvMOcuAP1x2QrG_VTXHwUz? UzMFid

1-3.8 0.0 3-7.9 3-7.9 7-0-10 5-3-13 12-4-7 5-2-9 17-7-0 5-2-9 22-3-9 5-3-13 28-1-6 3-5-1 31-8-7 35-2-0 36-5-8 1-3-8
Scale = 1:57.6

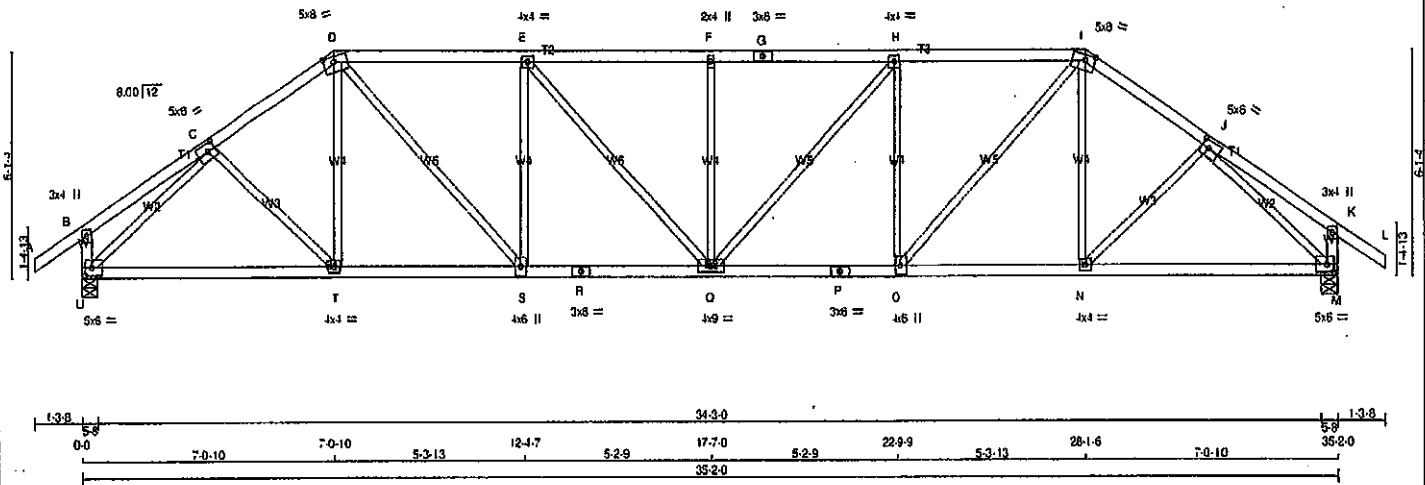

TOTAL WEIGHT = 2 X 151 = 303 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR
A - D	2x4 DRY	No.2	SPF		
D - G	2x4 DRY	No.2	SPF		
G - I	2x4 DRY	No.2	SPF		
I - L	2x4 DRY	No.2	SPF		
U - B	2x4 DRY	No.2	SPF		
M - K	2x4 DRY	No.2	SPF		
U - R	2x4 DRY	No.2	SPF		
R - P	2x4 DRY	No.2	SPF		
P - M	2x4 DRY	No.2	SPF		
ALL WEBS	2x3 DRY	No.2	SPF		
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (Table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-i	MT20	5.0	6.0	2.50	2.50
D	TTWW-m	MT20	5.0	8.0	1.75	3.50
E	TMWW-i	MT20	4.0	4.0		
F	TMWW-w	MT20	2.0	4.0		
G	TS-i	MT20	3.0	6.0		
H	TMWW-i	MT20	4.0	4.0		
I	TTWW-m	MT20	5.0	6.0	1.75	3.50
J	TMWW-i	MT20	5.0	6.0	2.50	2.50
K	TMV+p	MT20	3.0	4.0		
M	BMVW-i	MT20	5.0	6.0	2.50	2.25
N	BMWW-i	MT20	4.0	4.0		
O	BMWW-i	MT20	4.0	6.0		
P	BS-i	MT20	3.0	6.0		
Q	BMVWW-i	MT20	4.0	9.0		
R	BS-i	MT20	3.0	6.0		
S	BMWW-i	MT20	4.0	6.0		
T	BMWW-i	MT20	4.0	4.0		
U	BMVW-i	MT20	5.0	6.0	2.50	2.25

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
U	2065	0	2065	0
M	2065	0	2065	0

UNFACTORED REACTIONS

1ST LGASE	MAX. MIN. COMPONENT REACTIONS	1ST LGASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
U	1458	970	0
M	1458	970	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.53 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX.	MAX.	MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX.	MAX.	MEMB.
	FORCE	(PLF)			CS1 (LC)	UNBRAC		FORCE	(PLF)			CS1 (LC)	UNBRAC	
FR-TO							FR-TO							FR-TO
A-B	0 35	-91.8	-91.8	0.12 (1)	10.00	C-T	0 135	0.03 (4)						
B-C	0 18	-91.8	-91.8	0.18 (1)	10.00	T-D	0 90	0.03 (4)						
C-D	-2305 0	-91.8	-91.8	0.23 (1)	4.31	D-S	0 1218	0.27 (1)						
D-E	-2723 0	-91.8	-91.8	0.54 (1)	3.69	S-E	-814 0	0.48 (1)						
E-F	-2966 0	-91.8	-91.8	0.58 (1)	3.53	E-Q	0 363	0.08 (1)						
F-G	-2966 0	-91.8	-91.8	0.58 (1)	3.53	Q-F	-440 0	0.28 (1)						
G-H	-2966 0	-91.8	-91.8	0.58 (1)	3.53	H-Q	0 363	0.08 (1)						
H-I	-2723 0	-91.8	-91.8	0.54 (1)	3.69	Q-H	-814 0	0.48 (1)						
I-J	-2305 0	-91.8	-91.8	0.23 (1)	4.31	O-I	0 1218	0.27 (1)						
J-K	0 18	-91.8	-91.8	0.18 (1)	10.00	N-I	0 80	0.03 (4)						
K-L	0 35	-91.8	-91.8	0.12 (1)	10.00	N-J	0 135	0.03 (4)						
U-B	-255 0	0.0	0.0	0.03 (1)	7.81	U-C	-2514 0	0.87 (1)						
M-K	-255 0	0.0	0.0	0.03 (1)	7.81	J-M	-2514 0	0.87 (1)						
U-T	0 1801	-18.5	-18.5	0.40 (1)	10.00									
T-S	0 1900	-18.5	-18.5	0.41 (1)	10.00									
S-R	0 2723	-18.5	-18.5	0.49 (1)	10.00									
R-Q	0 2723	-18.5	-18.5	0.49 (1)	10.00									
Q-P	0 2723	-18.5	-18.5	0.49 (1)	10.00									
P-O	0 2723	-18.5	-18.5	0.49 (1)	10.00									
O-N	0 1900	-18.5	-18.5	0.41 (1)	10.00									
N-M	0 1801	-18.5	-18.5	0.40 (1)	10.00									

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	25.6	PSF
	DL	6.0	PSF
BOT CH.	LL	0.0	PSF
	DL	7.4	PSF
TOTAL LOAD		39.0	PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L 360 (1.17")
CALCULATED VERT. DEFL.(LL) = L 999 (0.16")
ALLOWABLE DEFL.(TL) = L 360 (1.17")
CALCULATED VERT. DEFL.(TL) = L 999 (0.29")

CS1: TC=0.58/1.00 (E-F:1), BC=0.49/1.00 (O-Q:1), WB=0.97/1.00 (J-M:1), SS1=0.23/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 786	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (M) INPUT = 0.90)
JSI METAL= 0.84 (P) INPUT = 1.00)

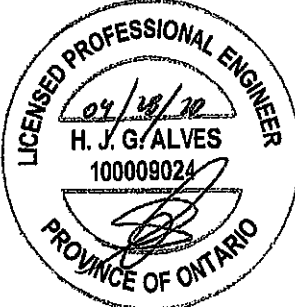

Structural component only
DWG# T-2007805

JOB NAME 408222	TRUSS NAME T4	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 M/Tek Industries, Inc. Tue Apr 28 09:00:07 2020 Page 1	ID:DMCubINVR6TslFoe31v6l_zns1l-LrSn2CZsDQdXWzpsSuwQTsbZlgK2C5T4u8iVWwzMFic
Scale = 1:57.6					

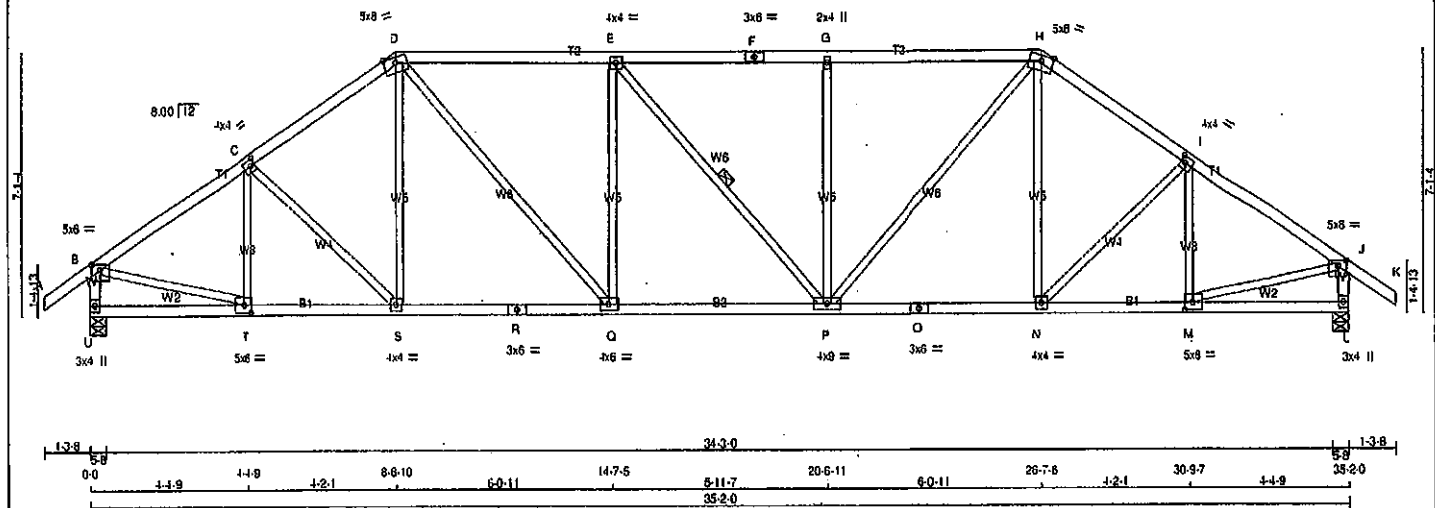

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. SPF A - D 2x4 DRY No.2 SPF E - F 2x4 DRY No.2 SPF G - H 2x4 DRY No.2 SPF I - K 2x4 DRY No.2 SPF L - J 2x4 DRY No.2 SPF U - R 2x4 DRY No.2 SPF R - O 2x4 DRY No.2 SPF O - L 2x4 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT DRY, SEASONED LUMBER.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED GROSS REACTION JT VERT 2065 0 L 2065 0 MAXIMUM FACTORED GROSS REACTION DOWN 2065 0 UPLIFT 0 0 INPUT BRG IN-SX 5-8 5-8 RECORD BRG IN-SX 5-8 5-8 UNFACTORED REACTIONS 1ST LCASE MAX. MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM. LIVE WIND DEAD SOIL U 1458 970 0 0 0 0 0 0 0 L 1458 970 0 0 0 0 0 0 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. 1 LATERAL BRACE(S) AT 1:2 LENGTH OF E-P. END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW LOADING TOTAL LOAD CASES: (4) <table> <tr> <th colspan="4">CHORDS</th><th colspan="4">WEBS</th></tr> <tr> <th>MEMB.</th><th>MAX. FORCE (LBS)</th><th>FACTORED VERT. LOAD (PLF)</th><th>MAX. LOAD (LC)</th><th>MEMB.</th><th>MAX. FORCE (LBS)</th><th>FACTORED VERT. LOAD (PLF)</th><th>MAX. LOAD (LC)</th></tr> <tr> <td>FR-TO</td><td></td><td></td><td></td><td>FR-TO</td><td></td><td></td><td></td></tr> <tr> <td>A-B</td><td>0 35</td><td>-91.8</td><td>-91.8 0.12 (1)</td><td>10.00</td><td>T-C</td><td>-397 0</td><td>0.11 (1)</td></tr> <tr> <td>B-C</td><td>-2289 0</td><td>-91.8</td><td>-91.8 0.37 (1)</td><td>4.19</td><td>C-S</td><td>-78 0</td><td>0.05 (1)</td></tr> <tr> <td>C-D</td><td>-2254 0</td><td>-91.8</td><td>-91.8 0.36 (1)</td><td>4.21</td><td>S-D</td><td>0 155</td><td>0.04 (4)</td></tr> <tr> <td>D-E</td><td>-2485 0</td><td>-91.8</td><td>-91.8 0.64 (1)</td><td>3.72</td><td>D-Q</td><td>0 949</td><td>0.21 (1)</td></tr> <tr> <td>E-F</td><td>-2483 0</td><td>-91.8</td><td>-91.8 0.64 (1)</td><td>3.72</td><td>Q-E</td><td>-597 0</td><td>0.52 (1)</td></tr> <tr> <td>F-G</td><td>-2483 0</td><td>-91.8</td><td>-91.8 0.64 (1)</td><td>3.72</td><td>E-P</td><td>-2 0</td><td>0.00 (1)</td></tr> <tr> <td>G-H</td><td>-2483 0</td><td>-91.8</td><td>-91.8 0.63 (1)</td><td>3.74</td><td>P-G</td><td>-597 0</td><td>0.52 (1)</td></tr> <tr> <td>H-I</td><td>-2254 0</td><td>-91.8</td><td>-91.8 0.36 (1)</td><td>4.21</td><td>P-H</td><td>0 947</td><td>0.21 (1)</td></tr> <tr> <td>I-J</td><td>-2269 0</td><td>-91.8</td><td>-91.8 0.37 (1)</td><td>4.19</td><td>H-N</td><td>0 157</td><td>0.04 (4)</td></tr> <tr> <td>J-K</td><td>0 35</td><td>-91.8</td><td>-91.8 0.12 (1)</td><td>10.00</td><td>N-I</td><td>-78 0</td><td>0.05 (1)</td></tr> <tr> <td>U-B</td><td>-2027 0</td><td>0.0</td><td>0.0 0.21 (1)</td><td>5.84</td><td>M-I</td><td>-397 0</td><td>0.11 (1)</td></tr> <tr> <td>L-J</td><td>-2028 0</td><td>0.0</td><td>0.0 0.21 (1)</td><td>5.84</td><td>B-T</td><td>0 1985</td><td>0.44 (1)</td></tr> <tr> <td></td><td></td><td></td><td></td><td>M-J</td><td>0 1985</td><td>0.44 (1)</td><td></td></tr> <tr> <td>U-T</td><td>0 0</td><td>-18.5</td><td>-18.5 0.08 (4)</td><td>10.00</td><td></td><td></td><td></td></tr> <tr> <td>T-S</td><td>0 1908</td><td>-18.5</td><td>-18.5 0.37 (1)</td><td>10.00</td><td></td><td></td><td></td></tr> <tr> <td>S-R</td><td>0 1853</td><td>-18.5</td><td>-18.5 0.36 (1)</td><td>10.00</td><td></td><td></td><td></td></tr> <tr> <td>R-Q</td><td>0 1853</td><td>-18.5</td><td>-18.5 0.36 (1)</td><td>10.00</td><td></td><td></td><td></td></tr> <tr> <td>Q-P</td><td>0 2485</td><td>-18.5</td><td>-18.5 0.47 (1)</td><td>10.00</td><td></td><td></td><td></td></tr> <tr> <td>P-O</td><td>0 1854</td><td>-18.5</td><td>-18.5 0.36 (1)</td><td>10.00</td><td></td><td></td><td></td></tr> <tr> <td>O-N</td><td>0 1854</td><td>-18.5</td><td>-18.5 0.36 (1)</td><td>10.00</td><td></td><td></td><td></td></tr> <tr> <td>N-M</td><td>0 1908</td><td>-18.5</td><td>-18.5 0.37 (1)</td><td>10.00</td><td></td><td></td><td></td></tr> <tr> <td>M-L</td><td>0 0</td><td>-18.5</td><td>-18.5 0.08 (4)</td><td>10.00</td><td></td><td></td><td></td></tr> </table>				CHORDS				WEBS				MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LOAD (LC)	MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LOAD (LC)	FR-TO				FR-TO				A-B	0 35	-91.8	-91.8 0.12 (1)	10.00	T-C	-397 0	0.11 (1)	B-C	-2289 0	-91.8	-91.8 0.37 (1)	4.19	C-S	-78 0	0.05 (1)	C-D	-2254 0	-91.8	-91.8 0.36 (1)	4.21	S-D	0 155	0.04 (4)	D-E	-2485 0	-91.8	-91.8 0.64 (1)	3.72	D-Q	0 949	0.21 (1)	E-F	-2483 0	-91.8	-91.8 0.64 (1)	3.72	Q-E	-597 0	0.52 (1)	F-G	-2483 0	-91.8	-91.8 0.64 (1)	3.72	E-P	-2 0	0.00 (1)	G-H	-2483 0	-91.8	-91.8 0.63 (1)	3.74	P-G	-597 0	0.52 (1)	H-I	-2254 0	-91.8	-91.8 0.36 (1)	4.21	P-H	0 947	0.21 (1)	I-J	-2269 0	-91.8	-91.8 0.37 (1)	4.19	H-N	0 157	0.04 (4)	J-K	0 35	-91.8	-91.8 0.12 (1)	10.00	N-I	-78 0	0.05 (1)	U-B	-2027 0	0.0	0.0 0.21 (1)	5.84	M-I	-397 0	0.11 (1)	L-J	-2028 0	0.0	0.0 0.21 (1)	5.84	B-T	0 1985	0.44 (1)					M-J	0 1985	0.44 (1)		U-T	0 0	-18.5	-18.5 0.08 (4)	10.00				T-S	0 1908	-18.5	-18.5 0.37 (1)	10.00				S-R	0 1853	-18.5	-18.5 0.36 (1)	10.00				R-Q	0 1853	-18.5	-18.5 0.36 (1)	10.00				Q-P	0 2485	-18.5	-18.5 0.47 (1)	10.00				P-O	0 1854	-18.5	-18.5 0.36 (1)	10.00				O-N	0 1854	-18.5	-18.5 0.36 (1)	10.00				N-M	0 1908	-18.5	-18.5 0.37 (1)	10.00				M-L	0 0	-18.5	-18.5 0.08 (4)	10.00				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 25.6 PSF DL = 8.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF NBCC 2018, OBC 2012, ABC 2019 - PART 9 OF OBC 2012 (2019 AMENDMENT) - CSA 088-09, CSA 088-14 - TPIC 2011, TPIC 2014 (55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL) = L/360 (1.17") CALCULATED VERT. DEFL.(LL) = L/998 (0.12") ALLOWABLE DEFL.(TL) = L/360 (1.17") CALCULATED VERT. DEFL.(TL) = L/998 (0.24") CSI: TC=0.84/1.00 (D-E:1), BC=0.47/1.00 (P-Q:1), WB=0.52/1.00 (E-Q:1), SSI=0.26/1.00 (D-E:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10 COMPANION LIVE LOAD FACTOR = 1.00 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1867 788 1987 1856 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.90 (I) INPUT = 0.90 I JSI METAL= 0.62 (I) INPUT = 1.00 I			
CHORDS				WEBS																																																																																																																																																																																																															
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LOAD (LC)	MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LOAD (LC)																																																																																																																																																																																																												
FR-TO				FR-TO																																																																																																																																																																																																															
A-B	0 35	-91.8	-91.8 0.12 (1)	10.00	T-C	-397 0	0.11 (1)																																																																																																																																																																																																												
B-C	-2289 0	-91.8	-91.8 0.37 (1)	4.19	C-S	-78 0	0.05 (1)																																																																																																																																																																																																												
C-D	-2254 0	-91.8	-91.8 0.36 (1)	4.21	S-D	0 155	0.04 (4)																																																																																																																																																																																																												
D-E	-2485 0	-91.8	-91.8 0.64 (1)	3.72	D-Q	0 949	0.21 (1)																																																																																																																																																																																																												
E-F	-2483 0	-91.8	-91.8 0.64 (1)	3.72	Q-E	-597 0	0.52 (1)																																																																																																																																																																																																												
F-G	-2483 0	-91.8	-91.8 0.64 (1)	3.72	E-P	-2 0	0.00 (1)																																																																																																																																																																																																												
G-H	-2483 0	-91.8	-91.8 0.63 (1)	3.74	P-G	-597 0	0.52 (1)																																																																																																																																																																																																												
H-I	-2254 0	-91.8	-91.8 0.36 (1)	4.21	P-H	0 947	0.21 (1)																																																																																																																																																																																																												
I-J	-2269 0	-91.8	-91.8 0.37 (1)	4.19	H-N	0 157	0.04 (4)																																																																																																																																																																																																												
J-K	0 35	-91.8	-91.8 0.12 (1)	10.00	N-I	-78 0	0.05 (1)																																																																																																																																																																																																												
U-B	-2027 0	0.0	0.0 0.21 (1)	5.84	M-I	-397 0	0.11 (1)																																																																																																																																																																																																												
L-J	-2028 0	0.0	0.0 0.21 (1)	5.84	B-T	0 1985	0.44 (1)																																																																																																																																																																																																												
				M-J	0 1985	0.44 (1)																																																																																																																																																																																																													
U-T	0 0	-18.5	-18.5 0.08 (4)	10.00																																																																																																																																																																																																															
T-S	0 1908	-18.5	-18.5 0.37 (1)	10.00																																																																																																																																																																																																															
S-R	0 1853	-18.5	-18.5 0.36 (1)	10.00																																																																																																																																																																																																															
R-Q	0 1853	-18.5	-18.5 0.36 (1)	10.00																																																																																																																																																																																																															
Q-P	0 2485	-18.5	-18.5 0.47 (1)	10.00																																																																																																																																																																																																															
P-O	0 1854	-18.5	-18.5 0.36 (1)	10.00																																																																																																																																																																																																															
O-N	0 1854	-18.5	-18.5 0.36 (1)	10.00																																																																																																																																																																																																															
N-M	0 1908	-18.5	-18.5 0.37 (1)	10.00																																																																																																																																																																																																															
M-L	0 0	-18.5	-18.5 0.08 (4)	10.00																																																																																																																																																																																																															



Structural component only
DWG# T-2007606


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T5	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:00:08 2020 Page 1

ID:DMCubINVR6TstFoe31v6l zns1l-BXPg ODBdxyU8Y??bRV048iM4gExZrD7oSS52NzMFib

1-3.8 0.0 5-1.9 5-1.9 4-11.1 10-0-10 7-6.6 17-7-0 7-6.6 25-1-6 4-11-1 30-0-7 5-1-9 1-3-8 35-2-0 38-5-8 1-3-8 Scale = 1/8" = 1'-0"

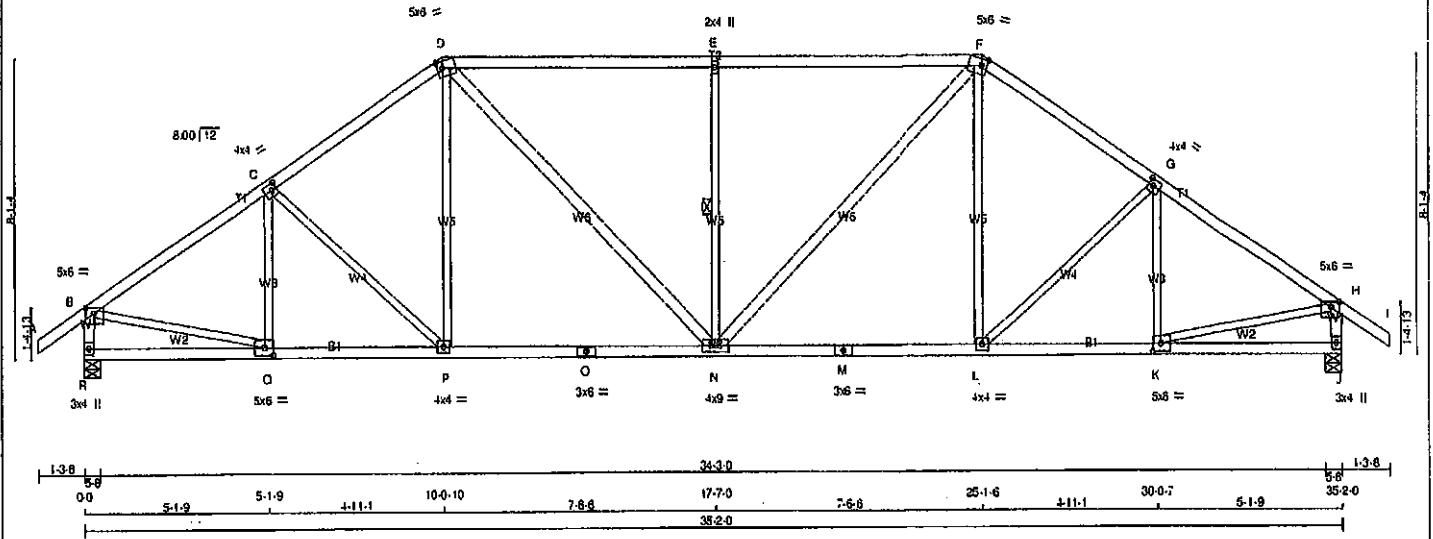

TOTAL WEIGHT = 2 X 158 = 317 lb (M/F)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - I	2x4	DRY	No.2	SPF	
R - B	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
R - O	2x4	DRY	No.2	SPF	
O - M	2x4	DRY	No.2	SPF	
M - J	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
D - N	2x4	DRY	No.2	SPF	
N - F	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	2.75
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TTWW-m	MT20	5.0	6.0	2.25	1.75
E	TMVW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	6.0	2.25	1.75
G	TMVW-t	MT20	4.0	4.0	2.00	1.50
H	TMVW-p	MT20	5.0	6.0	1.75	2.75
J	BMV1-p	MT20	3.0	4.0		
K	BMVW-t	MT20	5.0	6.0	2.50	2.75
L	BMVW-t	MT20	4.0	4.0		
M	BS-1	MT20	3.0	6.0		
N	BMVW-t	MT20	4.0	6.0		
O	BS-1	MT20	3.0	4.0		
P	BMVW-t	MT20	5.0	6.0	2.50	2.75
Q	BMVW-t	MT20	5.0	6.0	2.50	2.75
R	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	GROSS REACTION	MAXIMUM FACTORED	INPUT	RECORD
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
R	2085	0	2085	0	5-8
J	2085	0	2085	0	5-8

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE	
R	1458	970	0	0	0
J	1458	970	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING	TOTAL LOAD CASES: (4)	CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	UNBRAC	W E B S	MAX. FACTORED
MEMB.	FORCE	(LBS)	VERT. LOAD	(PLF)	CSI (LC)	UNBRAC	LENGTH	FR-TO	MEMB.	FORCE
FR-TO	0 35		-91.8	-91.8	0.12 (1)	10.00	Q-C	-321	0	0.11 (1)
A-B	2317	0	-91.8	-91.8	0.38 (1)	4.18	C-P	-218	0	0.18 (1)
B-C	2185	0	-91.8	-91.8	0.37 (1)	4.28	P-D	0	266	0.06 (1)
C-D	2185	0	-91.8	-91.8	0.81 (1)	3.47	D-N	0	691	0.11 (1)
D-E	2274	0	-91.8	-91.8	0.81 (1)	3.47	N-E	-851	0	0.35 (1)
E-F	2274	0	-91.8	-91.8	0.37 (1)	4.28	N-F	0	691	0.11 (1)
F-G	2185	0	-91.8	-91.8	0.37 (1)	4.18	L-F	0	266	0.06 (1)
G-H	2317	0	-91.8	-91.8	0.38 (1)	4.18	L-F	0	266	0.06 (1)
H-I	0 35		-91.8	-91.8	0.12 (1)	10.00	L-G	-218	0	0.18 (1)
I-B	-2022	0	0.0	0.0	0.21 (1)	5.94	K-G	-321	0	0.11 (1)
J-H	-2022	0	0.0	0.0	0.21 (1)	5.94	B-Q	0	1995	0.45 (1)
R-Q	0 0		-18.5	-18.5	0.10 (4)	10.00	K-H	0	1995	0.45 (1)
Q-P	0 1953		-18.5	-18.5	0.40 (1)	10.00				
P-O	0 1794		-18.5	-18.5	0.41 (1)	10.00				
O-N	0 1794		-18.5	-18.5	0.41 (1)	10.00				
N-M	0 1794		-18.5	-18.5	0.41 (1)	10.00				
M-L	0 1794		-18.5	-18.5	0.41 (1)	10.00				
L-K	0 1953		-18.5	-18.5	0.40 (1)	10.00				
K-J	0 0		-18.5	-18.5	0.10 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

15% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CSI: TC=0.81/1.00 (E/F:1), BC=0.41/1.00 (L/N:1), WB=0.45/1.00 (H/K:1), SS=0.34/1.00 (D/E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.25 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (H) (INPUT = 0.90)
JSI METAL = 0.84 (M) (INPUT = 1.00)




Structural component only
DWG# T-2007607

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T6	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:09 2020 Page 1

ID:DMCubINVR6TslFos31v6f_zns1-ljyCCkEpOrgLmp6BZlykZHqkxU0ng01MLSBapzMFia

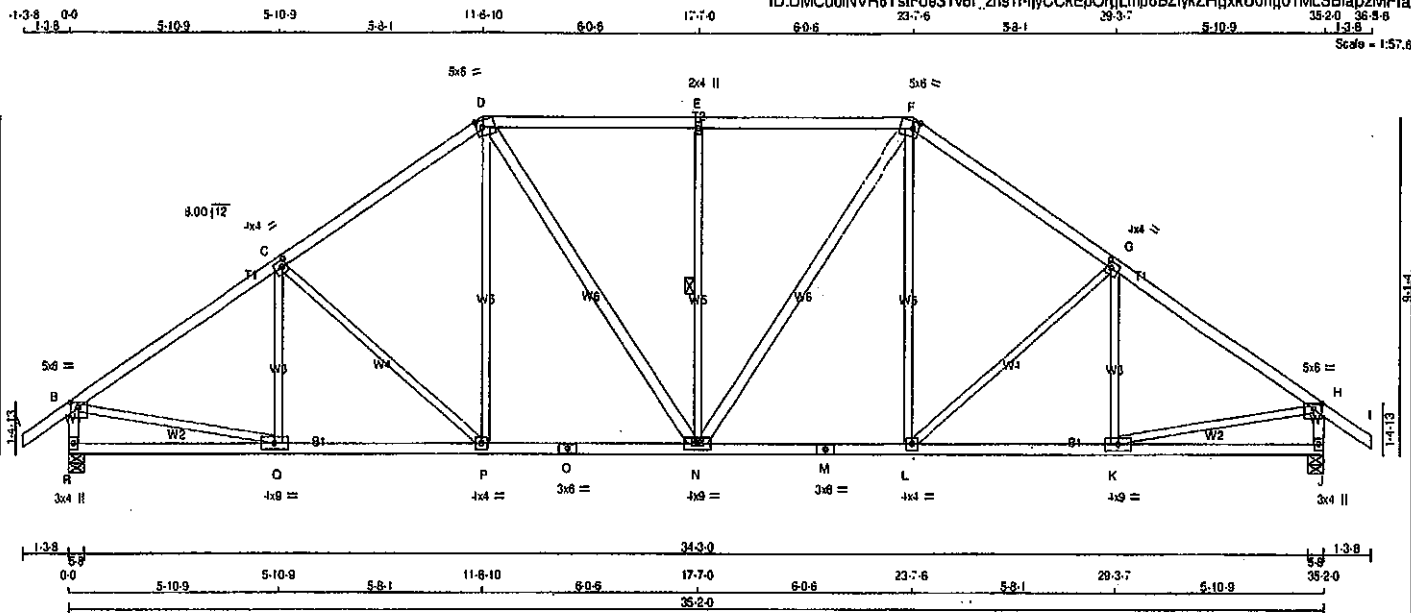

TOTAL WEIGHT = 2 X 165 = 329 lb

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - I	2x4	DRY No.2	SPF
I - H	2x4	DRY No.2	SPF
H - G	2x4	DRY No.2	SPF
G - J	2x4	DRY No.2	SPF
J - K	2x4	DRY No.2	SPF
K - L	2x4	DRY No.2	SPF
L - M	2x4	DRY No.2	SPF
M - N	2x4	DRY No.2	SPF
N - O	2x4	DRY No.2	SPF
O - P	2x4	DRY No.2	SPF
P - Q	2x4	DRY No.2	SPF
Q - R	2x4	DRY No.2	SPF
R - S	2x4	DRY No.2	SPF
S - T	2x4	DRY No.2	SPF
T - U	2x4	DRY No.2	SPF
U - V	2x4	DRY No.2	SPF
V - W	2x4	DRY No.2	SPF
W - X	2x4	DRY No.2	SPF
X - Y	2x4	DRY No.2	SPF
Y - Z	2x4	DRY No.2	SPF
Z - A	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)	W	LEN	Y	X
JT TYPE PLATES	5.0	6.0	1.75	2.75
B TMVW-p MT20	4.0	4.0	2.00	1.50
C TMVW-w MT20	5.0	6.0	2.25	2.00
D TMVW-w MT20	2.0	4.0		
E TMVW-w MT20	5.0	6.0	2.25	2.00
F TMVW-w MT20	4.0	4.0	2.00	1.50
G TMVW-w MT20	5.0	6.0	1.75	2.75
H TMVW-p MT20	3.0	4.0		
I BMVW-p MT20	4.0	9.0		
K BMVW-w MT20	4.0	4.0		
L BS-1 MT20	3.0	6.0		
M BMVW-w MT20	4.0	9.0		
N BS-1 MT20	3.0	6.0		
O BMVW-w MT20	4.0	4.0		
P BMVW-w MT20	4.0	9.0		
Q BMVW-w MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	
JT	VERT	DOWN	UPLIFT	IN-SX
R	2085	0	5.8	5.8
J	2085	0	0	5.8

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1458	970	0	0	0	488	0
J	1458	970	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 35	-91.8 -91.8	0.12 (1)	10.00	Q-C	-249 11 0.11 (1)	
B-C	-2348 0	-91.8 -91.8	0.52 (1)	3.99	C-P	-358 0 0.42 (1)	
C-D	-2095 0	-91.8 -91.8	0.48 (1)	4.22	P-D	0 341 0.08 (1)	
D-E	-1985 0	-91.8 -91.8	0.49 (1)	4.26	D-N	0 477 0.08 (1)	
E-F	-1985 0	-91.8 -91.8	0.49 (1)	4.26	N-E	-678 0 0.37 (1)	
F-G	-2095 0	-91.8 -91.8	0.48 (1)	4.22	N-F	0 477 0.08 (1)	
G-H	-2348 0	-91.8 -91.8	0.52 (1)	3.99	L-F	0 341 0.08 (1)	
H-I	0 35	-91.8 -91.8	0.12 (1)	10.00	L-G	-358 0 0.42 (1)	
I-B	-2018 0	0.0 0.0	0.21 (1)	5.94	K-G	-249 11 0.11 (1)	
J-H	-2018 0	0.0 0.0	0.21 (1)	5.94	B-Q	0 201 0.45 (1)	
					K-H	0 201 0.45 (1)	
R-Q	0 0	-18.5 -18.5	0.14 (4)	10.00			
Q-P	0 1980	-18.5 -18.5	0.39 (1)	10.00			
P-O	0 1718	-18.5 -18.5	0.34 (1)	10.00			
O-N	0 1716	-18.5 -18.5	0.34 (1)	10.00			
N-M	0 1718	-18.5 -18.5	0.34 (1)	10.00			
M-L	0 1718	-18.5 -18.5	0.34 (1)	10.00			
L-K	0 1981	-18.5 -18.5	0.39 (1)	10.00			
K-J	0 0	-18.5 -18.5	0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019

- PART 9 OF CBC 2012 (2019 AMENDMENT)

- CSA 088-09, CSA 088-14

- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.10')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.19')

CS: TC=0.52/1.00 (G-H); SC=0.39/1.00 (K-L); WB=0.45/1.00 (H-K); SS=0.27/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
-MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1668


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (H) INPUT = 0.90
JSI METAL = 0.58 (M) INPUT = 1.00



Structural component only
DWG# T-2007608

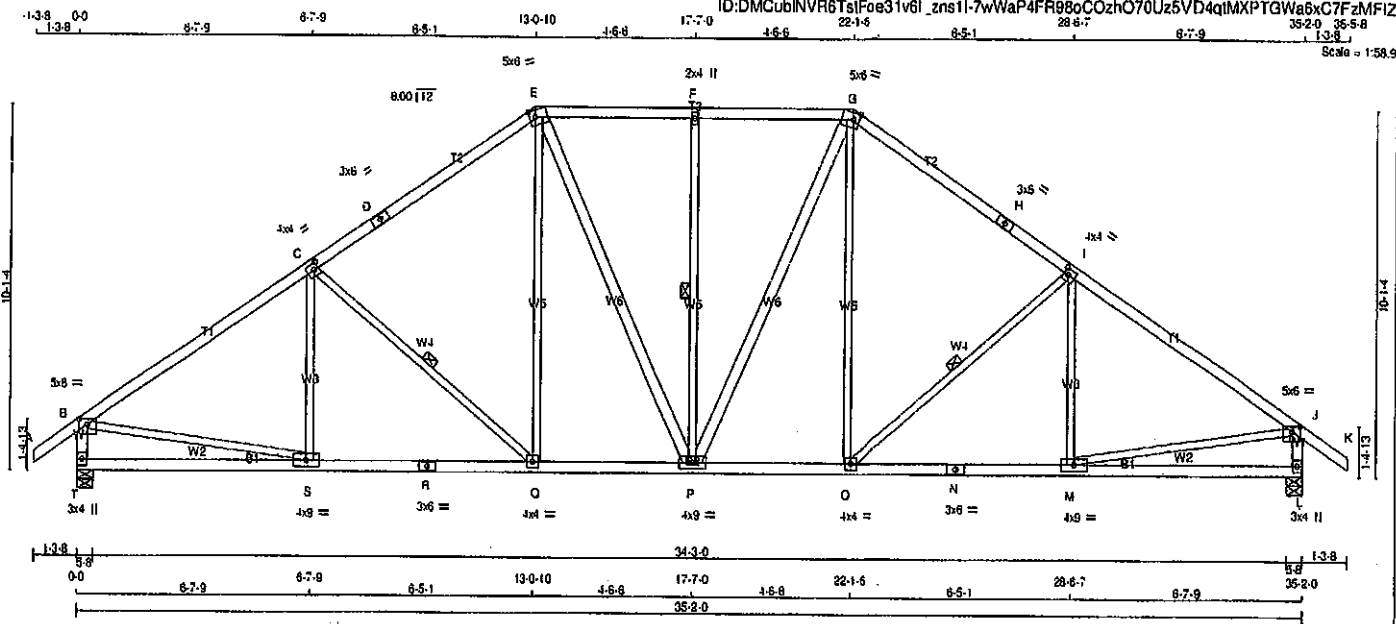

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2 SPF
D - E	2x4	DRY	No.2 SPF
E - G	2x4	DRY	No.2 SPF
G - H	2x4	DRY	No.2 SPF
H - K	2x4	DRY	No.2 SPF
T - B	2x4	DRY	No.2 SPF
L - J	2x4	DRY	No.2 SPF
T - R	2x4	DRY	No.2 SPF
R - N	2x4	DRY	No.2 SPF
N - L	2x4	DRY	No.2 SPF
ALL WEBS	2x3	DRY	No.2 SPF
EXCEPT			
E - P	2x4	DRY	No.2 SPF
P - G	2x4	DRY	No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	2.75
C	TMWW-l	MT20	4.0	4.0	2.00	1.50
D	TS-l	MT20	3.0	6.0		
E	TTWW-m	MT20	5.0	6.0	2.25	2.00
F	TMW-w	MT20	2.0	4.0		
G	TTWW-m	MT20	5.0	6.0	2.25	2.00
H	TS-l	MT20	3.0	6.0		
I	TMWW-l	MT20	4.0	4.0	2.00	1.50
J	TMVW-p	MT20	5.0	6.0	1.75	2.75
L	BMV1+p	MT20	3.0	4.0		
M	BMWW-l	MT20	4.0	9.0		
N	BS-l	MT20	3.0	6.0		
O	BMWW-l	MT20	4.0	9.0		
P	BMWW-l	MT20	4.0	9.0		
Q	BMWW-l	MT20	4.0	9.0		
R	BS-l	MT20	3.0	6.0		
S	BMWW-l	MT20	4.0	9.0		
T	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
T	2065	0	2065	0	5-8	5-8
L	2065	0	2065	0	5-8	5-8

UNFACTORED REACTIONS							
1ST LCASE		MAX-MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
T	1458	970.0	0.0	0.0	0.0	488.0	0.0
L	1458	970.0	0.0	0.0	0.0	488.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.
1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-Q, P-P, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM TO		FR-TO			
A-B	0 35	-91.8 -91.8 0.12 (1)	10.00	S-C	-189 46	0.10 (1)	
B-C	-2358 0	-91.8 -91.8 0.69 (1)	3.77	C-Q	-484 0	0.24 (1)	
C-D	-1996 0	-91.8 -91.8 0.62 (1)	4.11	Q-E	0 415	0.09 (1)	
D-E	-1996 0	-91.8 -91.8 0.62 (1)	4.11	E-P	0 315	0.05 (1)	
E-F	-1761 0	-91.8 -91.8 0.27 (1)	4.77	P-F	-502 0	0.35 (1)	
F-G	-1761 0	-91.8 -91.8 0.27 (1)	4.77	P-G	0 315	0.05 (1)	
G-H	-1996 0	-91.8 -91.8 0.62 (1)	4.11	O-G	0 415	0.09 (1)	
H-I	-1996 0	-91.8 -91.8 0.62 (1)	4.11	O-I	-484 0	0.24 (1)	
I-J	-2358 0	-91.8 -91.8 0.69 (1)	3.77	M-I	-189 46	0.10 (1)	
J-K	0 35	-91.8 -91.8 0.12 (1)	10.00	B-S	0 2021	0.45 (1)	
T-B	-2014 0	0.0 0.0 0.21 (1)	5.85	M-J	0 2021	0.45 (1)	
L-J	-2014 0	0.0 0.0 0.21 (1)	5.85				
T-S	0 0	-18.5 -18.5 0.19 (4)	10.00				
S-R	0 1995	-18.5 -18.5 0.42 (1)	10.00				
R-Q	0 1995	-18.5 -18.5 0.42 (1)	10.00				
Q-P	0 1829	-18.5 -18.5 0.32 (1)	10.00				
P-O	0 1829	-18.5 -18.5 0.32 (1)	10.00				
O-N	0 1895	-18.5 -18.5 0.42 (1)	10.00				
N-M	0 1995	-18.5 -18.5 0.42 (1)	10.00				
M-L	0 0	-18.5 -18.5 0.19 (4)	10.00				

TOTAL WEIGHT = 6 X 172 = 1030 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.0W/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.18")

CSI: TC=0.69:1.00 (I-J:1), BC=0.42:1.00 (M-O:1), WB=0.45:1.00 (J-M:1), SS=0.24:1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (J) INPUT = 0.90
JSI METAL= 0.67 (N) INPUT = 1.00



Structural component only
DWG# T-2007609


JOB NAME 408222	TRUSS NAME T8	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	-------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:00:10 2020 Page 1

ID:DMCubINVR6TstFos31v6I_zns11-7wWaP4FR88oCOzhO70Uz5VD1gtM2PTGwa6xC7FzMFIZ

1-3-8 0-0 7-4-9 7-4-9 7-2-1 14-6-10 6-0-12 20-7-6 7-2-1 27-9-7 7-4-9 35-2-0 1-3-8
Scale: 3/16"=1'

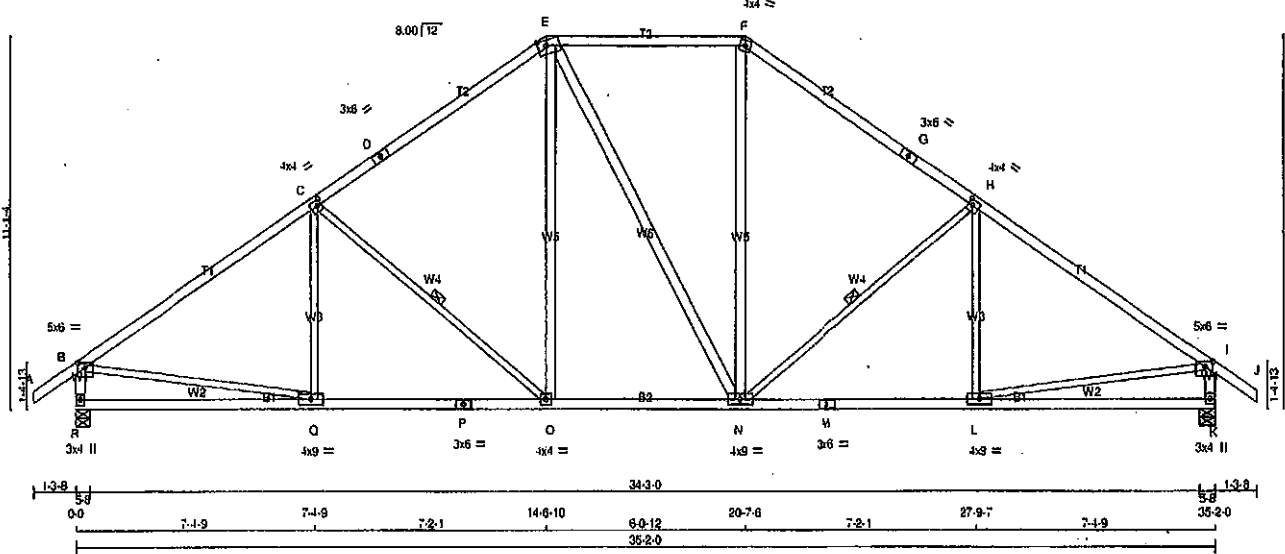

TOTAL WEIGHT = 2 X 166 = 333 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
E - F	2x4	DRY	No.2	SPF	
F - G	2x4	DRY	No.2	SPF	
G - J	2x4	DRY	No.2	SPF	
R - B	2x4	DRY	No.2	SPF	
K - I	2x4	DRY	No.2	SPF	
R - P	2x4	DRY	No.2	SPF	
P - M	2x4	DRY	No.2	SPF	
M - K	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	
O - E	2x4	DRY	No.2	SPF	
E - N	2x4	DRY	No.2	SPF	
N - F	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMWV-p	MT20	5.0	8.0	1.75	2.75
C TMWW-I	MT20	4.0	4.0	2.00	1.50
D TS-I	MT20	3.0	8.0		
E TTWW-m	MT20	5.0	8.0	2.00	3.00
F TTW-m	MT20	4.0	4.0		
G TS-I	MT20	3.0	8.0		
H TMWV-I	MT20	4.0	4.0	2.00	1.50
I TMWV-p	MT20	5.0	8.0	1.75	2.75
K BMV1-p	MT20	3.0	4.0		
L BMWV-I	MT20	4.0	9.0		
M BS-I	MT20	3.0	8.0		
N BMWVW-I	MT20	4.0	9.0		
O BMWV-I	MT20	4.0	4.0		
P BS-I	MT20	3.0	8.0		
Q BMWV-I	MT20	4.0	9.0		
R BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	2085	0	0	5-8
R 2085	0	2085	0	5-8
K 2085	0	2085	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1458	970	0	0	0	0	488	0
K	1458	970	0	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.45 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-O, H-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	FACTORED VERT. LOAD (LBS)	MAX. UNBRACED LENGTH (FT)	W E B S	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO							FR-TO		
A-B	0 35	-91.8	-91.8	0.12 (1)	10.00	C-C	-140 76	0.09 (1)	
B-C	-2357 0	-91.8	-91.8	0.89 (1)	3.45	C-O	-604 0	0.38 (1)	
C-D	-1888 0	-91.8	-91.8	0.78 (1)	3.91	O-E	0 499	0.08 (1)	
D-E	-1888 0	-91.8	-91.8	0.78 (1)	3.91	E-N	0 0	0.00 (1)	
E-F	-1538 0	-91.8	-91.8	0.47 (1)	4.74	N-H	0 500	0.08 (1)	
F-G	-1888 0	-91.8	-91.8	0.78 (1)	3.91	H-I	-604 0	0.38 (1)	
G-H	-1888 0	-91.8	-91.8	0.78 (1)	3.91	I-L	-140 75	0.09 (1)	
H-I	-2357 0	-91.8	-91.8	0.89 (1)	3.45	L-I	0 2020	0.45 (1)	
I-J	0 35	-91.8	-91.8	0.12 (1)	10.00				
R-B	-2009 0	0.0	0.0	0.21 (1)	5.95				
K-I	-2009 0	0.0	0.0	0.21 (1)	5.95				
R-Q	0 0	-18.5	-18.5	0.25 (4)	10.00				
O-P	0 1998	-18.5	-18.5	0.45 (1)	10.00				
P-O	0 1998	-18.5	-18.5	0.45 (1)	10.00				
O-N	0 1538	-18.5	-18.5	0.33 (1)	10.00				
N-M	0 1998	-18.5	-18.5	0.45 (1)	10.00				
M-L	0 1998	-18.5	-18.5	0.45 (1)	10.00				
L-K	0 0	-18.5	-18.5	0.24 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17')
CALCULATED VERT. DEFL. (LL) = L/999 (0.09')
ALLOWABLE DEFL. (TL) = L/360 (1.17')
CALCULATED VERT. DEFL. (TL) = L/999 (0.20')

CSK: TC=0.89(1.00) (B-C:1), BC=0.45(1.00) (O-C:1), WB=0.45(1.00) (O-I:1), SS=0.27(1.00) (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (F) INPUT = 0.90 (I)
JSI METAL= 0.68 (F) INPUT = 1.00 (I)




Structural component only
DWG# T-2007610

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T9	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:11 2020 Page 1

ID:DMCubINVR8t8lFoe31v6l_zns1l-b64ydQG4wSx377Gah7CeimKBHhBBzlfrmgmizMFIY

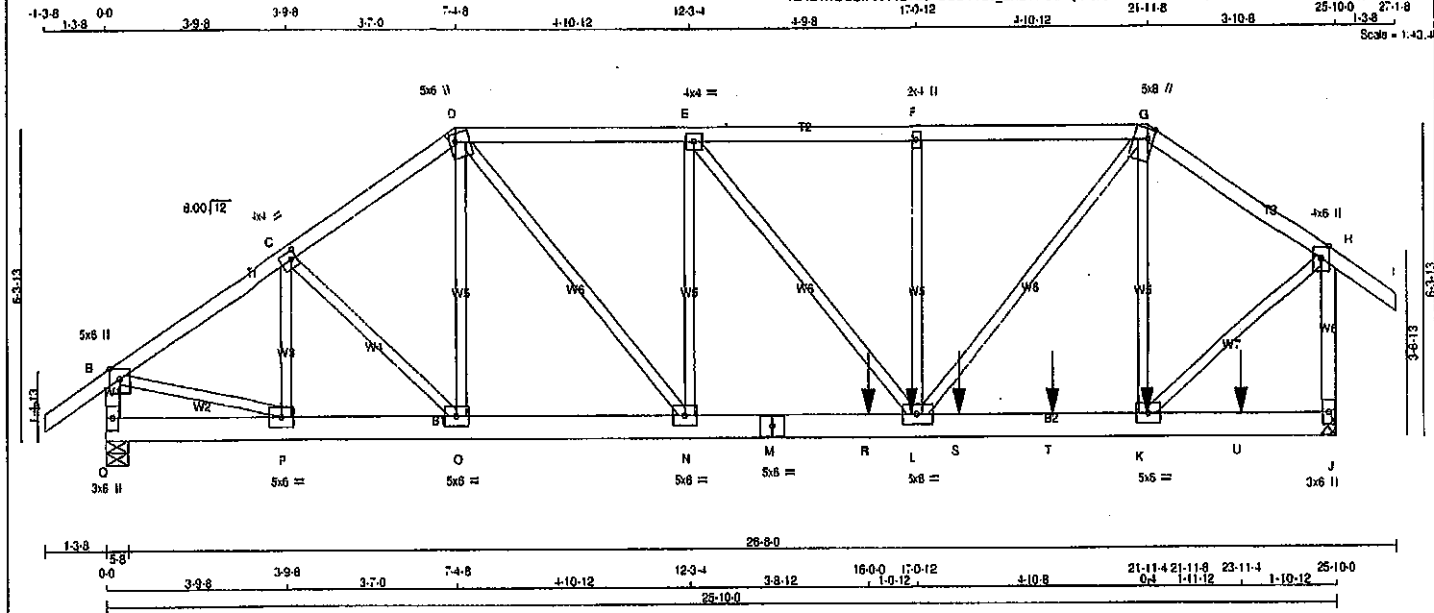

TOTAL WEIGHT = 2 X 138 = 271 lb

LUMBER	N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS	SIZE			
A - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
O - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
Q - M	2x6	DRY	No.2	SPF
M - J	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - D	12	TOP
D - G	12	TOP
G - I	12	TOP
Q - B	12	TOP
J - H	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
Q - M	12	TOP
M - J	12	SIDE (183.11)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
Q	2236	0	2236	0
J	3067	0	3067	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 4'-0.

UNFACTORED REACTIONS

	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
Q	1575	1085	0	0	0	510	0
J	2157	1479	0	0	0	678	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.97 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: 14)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORIZ. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)	
FR-TO		FROM TO		FR-TO			
A-B	0 35	-91.8 -91.8 0.07 (1)	10.00	P-C	-503 0	0.06 (1)	
B-C	-2484 0	-91.8 -91.8 0.13 (1)	5.62	C-O	0 70	0.01 (1)	
C-D	-2571 0	-91.8 -91.8 0.13 (1)	5.63	O-D	-2 80	0.01 (1)	
D-E	-3030 0	-91.8 -91.8 0.20 (1)	5.11	D-N	0 1433	0.16 (1)	
E-F	-3235 0	-91.8 -91.8 0.21 (1)	4.97	N-E	-738 0	0.22 (1)	
F-G	-3235 0	-91.8 -91.8 0.20 (1)	4.99	E-L	0 327	0.04 (1)	
G-H	-2123 0	-91.8 -91.8 0.15 (1)	5.91	L-F	-459 0	0.14 (1)	
H-I	0 35	-91.8 -91.8 0.07 (1)	10.00	L-G	0 2339	0.29 (1)	
Q-B	-2188 0	0.0 0.0 0.12 (1)	7.53	K-G	-995 0	0.30 (1)	
J-H	-2962 0	0.0 0.0 0.33 (1)	6.70	B-P	0 2137	0.28 (1)	
				K-H	0 2299	0.28 (1)	
Q-P	0 0	-18.5 -18.5 0.02 (1)	10.00				
P-O	0 2087	-18.5 -18.5 0.18 (1)	10.00				
O-N	0 2118	-18.5 -18.5 0.22 (1)	10.00				
N-M	0 3030	-18.5 -18.5 0.45 (1)	10.00				
M-R	0 3030	-18.5 -18.5 0.45 (1)	10.00				
R-L	0 3030	-18.5 -18.5 0.45 (1)	10.00				
L-S	0 1748	-18.5 -18.5 0.27 (1)	10.00				
S-T	0 1748	-18.5 -18.5 0.27 (1)	10.00				
T-K	0 1748	-18.5 -18.5 0.27 (1)	10.00				
K-U	0 0	-18.5 -18.5 0.08 (1)	10.00				
U-J	0 0	-18.5 -18.5 0.06 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
K	21-11-4	-187	-187	---	FRONT	VERT	TOTAL	C1
L	16-11-4	-187	-187	---	FRONT	VERT	TOTAL	C1
R	16-0-0	-1259	-1259	---	FRONT	VERT	TOTAL	C1
S	17-11-4	-187	-187	---	FRONT	VERT	TOTAL	C1
T	19-11-4	-187	-187	---	FRONT	VERT	TOTAL	C1
U	23-11-4	-195	-195	---	FRONT	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

ISS % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEF. (LL) = L/360 (0.88")
CALCULATED VERT. DEF. (LL) = L/999 (0.06")
ALLOWABLE DEF. (TL) = L/360 (0.88")
CALCULATED VERT. DEF. (TL) = L/999 (0.12")

CSI: TC=0.39/1.00 (H-J); BC=0.45/1.00 (L-N);
WB=0.30/1.00 (G-K); SS=0.35/1.00 (L-N);

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MIN	MAX	MIN
MT20	616	354
	1667	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.81 (H) (INPUT = 0.90)
JSI METAL= 0.53 (H) (INPUT = 1.00)




Structural component only
DWG# T-2007611 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T10	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:12 2020 Page 1

ID:DMCubINVR6TslFoe31v6I .zns11-4leLqmGihm3wdHmERWRAwLUKt4GtLp2QQJB8zMFIX

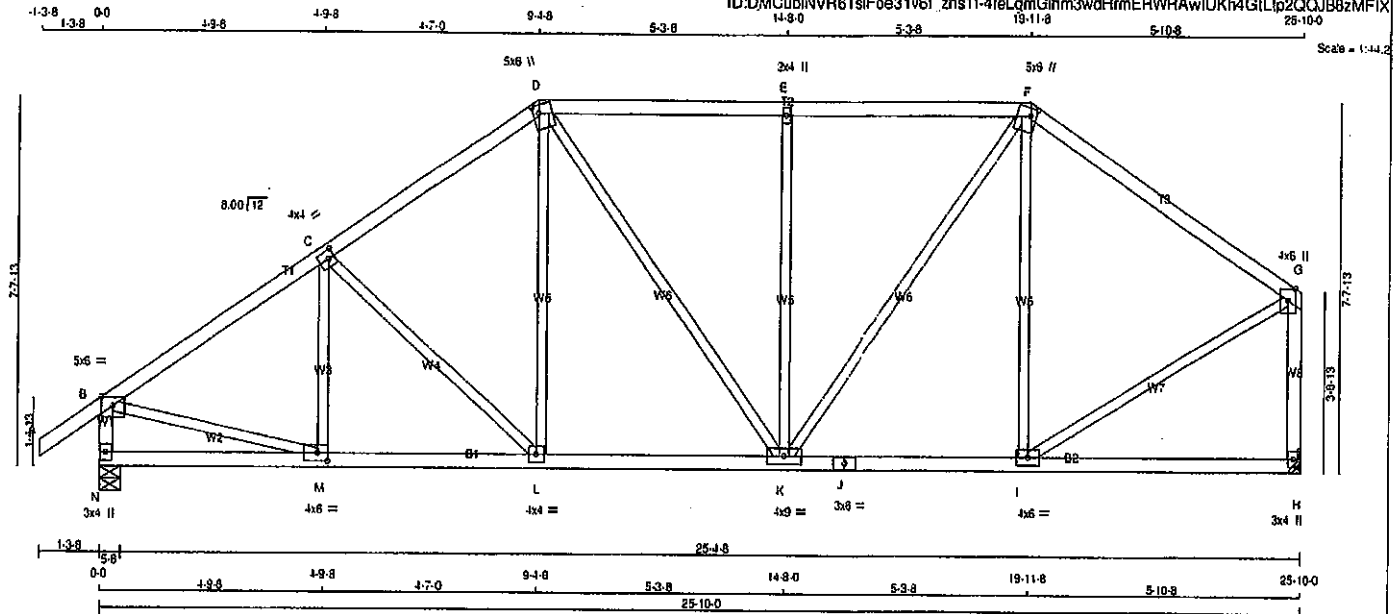

TOTAL WEIGHT = 118 lb
[M/F]

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
N - B	2x4	DRY	No.2
H - G	2x4	DRY	No.2
N - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	6.0	Edge	
C	TMWV-1	MT20	4.0	4.0	2.00	1.50
D	TTWV+m	MT20	5.0	6.0	2.00	1.50
E	TMWV-w	MT20	2.0	4.0		
F	TTWV+m	MT20	5.0	6.0	2.00	1.50
G	TMWV-p	MT20	4.0	6.0	Edge	
H	BMV1-p	MT20	3.0	4.0		
I	BMWV-1	MT20	4.0	6.0		
J	BS-1	MT20	3.0	6.0		
K	BMWVW-1	MT20	4.0	9.0		
L	BMWV-1	MT20	4.0	4.0		
M	BMWV-1	MT20	4.0	8.0	2.00	2.50
N	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
N	1550	0	1550	0
H	1424	0	1424	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
N	1084	731	0	0	0	0	363	0
H	1007	681	0	0	0	0	348	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.93 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
A-B	0	35	-91.8	M-C	-217	3	0.07 (1)
B-C	-1609	0	-91.8	C-L	-273	0	0.20 (1)
C-D	-1425	0	-91.8	L-D	0	290	0.06 (1)
D-E	-1272	0	-91.8	D-K	0	185	0.04 (1)
E-F	-1272	0	-91.8	K-E	-595	0	0.64 (1)
F-G	-1077	0	-91.8	K-F	0	656	0.15 (1)
G-H	-1511	0	0.0	F-I	-380	0	0.42 (1)
H-G	-1380	0	0.0	B-M	0	1396	0.31 (1)
				I-G	0	1031	0.23 (1)
N-M	0	0	-18.5				
M-L	0	1362	-18.5				
L-K	0	1164	-18.5				
K-J	0	890	-18.5				
J-I	0	890	-18.5				
I-H	0	0	-18.5				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9. NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.88")
CALCULATED VERT. DEFL.(LL) = L/989 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.88")
CALCULATED VERT. DEFL.(TL) = L/889 (0.09")

CSI: TC=0.43/1.00 (F-G:1), BC=0.27/1.00 (L-M:1), WB=0.84/1.00 (E-K:1), SS=0.23/1.00 (E-F:1)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1 10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (B) (INPUT = 0.80)
JSI METAL = 0.58 (G) (INPUT = 1.00)




Structural component only
DWG# T-2007612.

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T11A	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Tue Apr 28 09:00:12 2020 Page 1

ID:DMCubINVR6TstFoe31v6I zns11-4feLqmGihm3wdHrmERWRawIXHh2PIN5p2CQJB8zMFIX

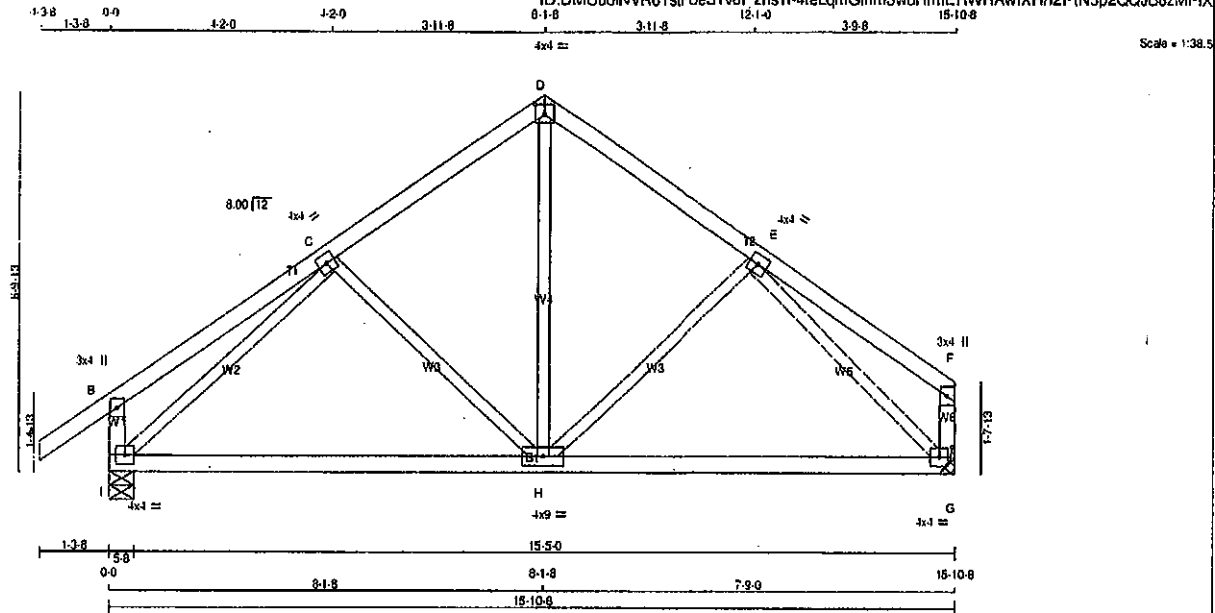

TOTAL WEIGHT = 2 X 66 = 132 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
I - B	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
I - G	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-1	MT20	4.0	4.0		
D	TTW-p	MT20	4.0	4.0	2.25	2.00
E	TMVW-1	MT20	4.0	4.0		
F	TMV+p	MT20	3.0	4.0		
G	BMVW1-1	MT20	4.0	4.0		
H	BMVW-1	MT20	4.0	4.0		
I	BMVW1-1	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

JT	FACTORED		MAXIMUM FACTORED		INPUT	REQD
	GROSS REACTION	GROSS REACTION	DOWN	HORIZ		
I	1001	0	1001	0	5-8	5-8
G	875	0	875	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
I	708	476 0	0 0	0 0	229 0	0 0
G	619	406 0	0 0	0 0	213 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	CHORDS			MEMB.	MAX. FACTORED FORCE (LBS)	WEBS		
		VERT. LOAD (PLF)	LC1 MAX	LC2 MAX			MAX. FACTORED FORCE (LBS)	LC1 MAX	LC2 MAX
FR-TO									
A-B	0 35	-91.8	-91.8	0.12 (1)	10.00	C-H	-228 0	0.12 (1)	
B-C	0 24	-91.8	-91.8	0.24 (1)	10.00	H-D	0 449	0.10 (1)	
C-D	-691 0	-91.8	-91.8	0.19 (1)	6.25	H-E	-186 0	0.09 (1)	
D-E	-889 0	-91.8	-91.8	0.17 (1)	6.25	I-C	-988 0	0.50 (1)	
E-F	0 24	-91.8	-91.8	0.22 (1)	10.00	E-G	-971 0	0.44 (1)	
I-B	-269 0	0.0	0.0	0.03 (1)	7.81				
G-F	-125 0	0.0	0.0	0.01 (1)	7.81				
I-H	0 722	-18.5	-18.5	0.39 (4)	10.00				
H-G	0 677	-18.5	-18.5	0.39 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.53")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.53")
CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CSI: TO=0.24 (1.00 (B-C:1), BC=0.39 (1.00 (H-I:4), WB=0.50 (1.00 (C-I:1), SI=0.15 (1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.84 (E) (INPUT = 0.90)
JSI METAL = 0.35 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007613

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T11B	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:01 2020 Page 1
ID:DMCubINVR6TstFoe31v61_zns11-SxVsS1cVvDTdV3g25IMsNOthBxxWB7PWeSQ4izMEMI

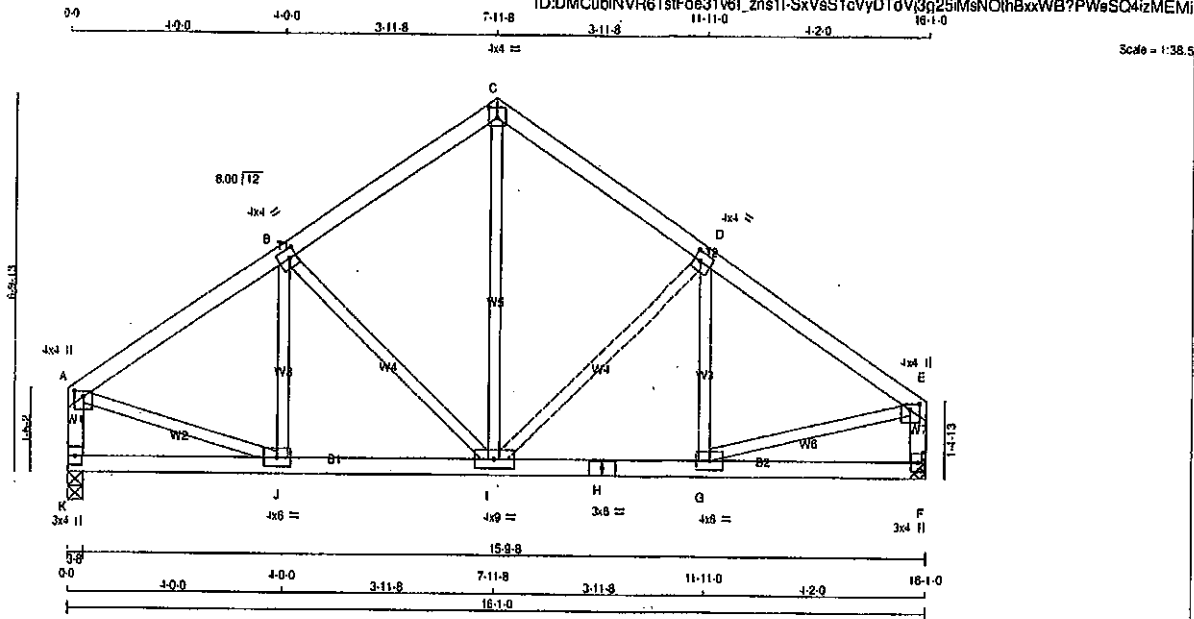

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2		
C - E	2x4	DRY	No.2		
K - A	2x4	DRY	No.2		
F - E	2x4	DRY	No.2		
K - H	2x4	DRY	No.2		
H - F	2x4	DRY	No.2		

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)	W	LEN	Y	X
A - TMVW+p	MT20	4.0	4.0	1.25 2.00
B - TMVW-i	MT20	4.0	4.0	2.00 1.50
C - ITW-p	MT20	4.0	4.0	2.25 2.00
D - TMVW-i	MT20	4.0	4.0	2.00 1.50
E - TMVW+p	MT20	4.0	4.0	1.25 2.00
F - BMV1+p	MT20	3.0	4.0	
G - BMVW-i	MT20	4.0	8.0	
H - BS-i	MT20	3.0	6.0	
I - BMVW-i	MT20	4.0	9.0	
J - BMVW-i	MT20	4.0	6.0	
K - BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	UP	IN-SX
K	887	0	0	3-8
F	887	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3-8.

UNFACTORED REACTIONS

1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	627	411	0	0	216	0
F	627	411	0	0	216	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX CSI (LC)	UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED MAX CSI (LC)
FR-TO						FR-TO			
A-B	-886	0	-91.8	-91.8	0.19 (1)	6.25	J-B	-142	18
B-C	-887	0	-91.8	-91.8	0.18 (1)	6.25	B-I	-263	0
C-D	-888	0	-91.8	-91.8	0.19 (1)	6.25	I-C	0	461
D-E	-891	0	-91.8	-91.8	0.20 (1)	6.25	I-D	-292	0
K-A	-855	0	0.0	0.0	0.09 (1)	7.81	G-D	-117	28
F-E	-853	0	0.0	0.0	0.09 (1)	7.81	A-J	0	772
							G-E	0	787
K-J	0	0	-18.5	-18.5	0.07 (4)	10.00			
J-I	0	740	-18.5	-18.5	0.15 (1)	10.00			
I-H	0	761	-18.5	-18.5	0.15 (1)	10.00			
H-G	0	761	-18.5	-18.5	0.15 (1)	10.00			
G-F	0	0	-18.5	-18.5	0.07 (4)	10.00			

TOTAL WEIGHT = 2 X 69 = 137 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9. NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.54")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.54")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSI: TC=0.20/1.00 (D-E:1), BC=0.15/1.00 (G-I:1), WB=0.18/1.00 (E-G:1), SS=0.15/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (E) (INPUT = 0.90)
JSI METAL = 0.25 (H) (INPUT = 1.00)



Structural component only
DWG# T-2007631




JSI GRIP = 0.89 I) (INPUT = 0.90)
JSI METAL = 0.47 K) (INPUT = 1.00)



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T12S	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:14 2020 Page 1

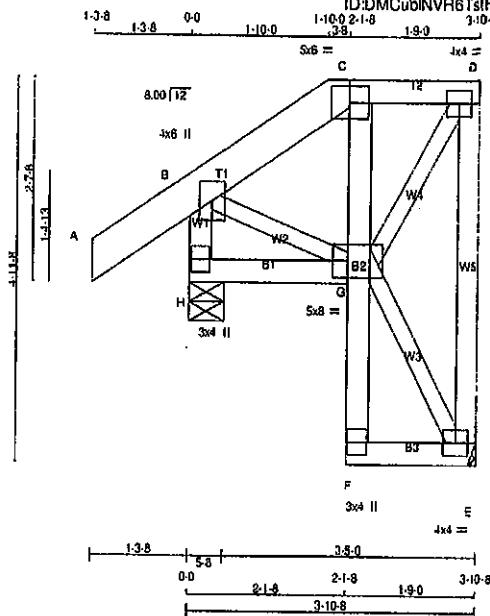

Scale = 1/2" = 1'-0"

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x8 DRY	No.2	SPF		
C - D	2x4 DRY	No.2	SPF		
D - E	2x4 DRY	No.2	SPF		
H - B	2x4 DRY	No.2	SPF		
H - G	2x4 DRY	No.2	SPF		
F - C	2x4 DRY	No.2	SPF		
F - E	2x4 DRY	No.2	SPF		
ALL WEBS EXCEPT	2x3 DRY	No.2	SPF		

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	6.0		
C	TTV-m	MT20	5.0	6.0		
D	TMVW-i	MT20	4.0	4.0		
E	BMVW1-i	MT20	4.0	4.0		
F	BMV+p	MT20	3.0	4.0		
G	BMVWW1-i	MT20	5.0	8.0	2.50	2.50
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG
E	VERT	DOWN	UPLIFT	IN-SX
E	214	0	214	0
H	344	0	344	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	151	99	0	0	0	52	0
H	241	172	0	0	0	69	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 36	-91.8 -91.8	0.07 (5)	G-D	0 139	0.03 (1)	
B-C	-105 0	-91.8 -91.8	0.03 (1)	B-G	0 96	0.02 (1)	
C-D	-79 0	-91.8 -91.8	0.05 (1)	G-E	-3 0	0.00 (1)	
E-D	-196 0	0.0 0.0	0.08 (1)				
H-B	-323 0	0.0 0.0	0.03 (1)				
H-G	0 0	-18.5 -18.5	0.03 (4)				
F-G	0 17	0.0 0.0	0.01 (1)				
G-C	-119 0	0.0 0.0	0.01 (1)				
F-E	0 2	-18.5 -18.5	0.01 (4)				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 31 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.08:1.00 (D:E=1), BC=0.03:1.00 (G:H=4), WB=0.03:1.00 (D-G=1), SS=0.07:1.00 (A-B=5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MT20	818	354
	1667	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.19 (B) (INPUT = 0.90)
JSI METAL= 0.11 (B) (INPUT = 1.00)

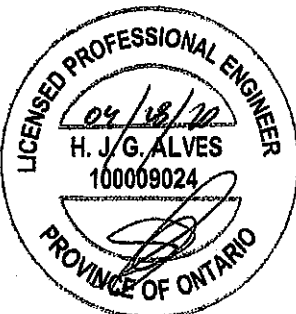

Structural component only
DWG# T-2007615


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T20	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 26 10:04:02 2020 Page 1

ID:DMCubINVR6TstF0e31v6l zns11-x73EgNd7jXbU6s8scoDbPaw0PaBNFZ7YIIB c82MEMH

1-3-8 0-0 4-10-0 5-2-12 6-0-6 11-3-2 6-3-14 17-7-0 6-3-14 23-10-14 6-5-2 30-4-0 4-10-0 35-2-0 1-3-8
Scale = 1:57.8

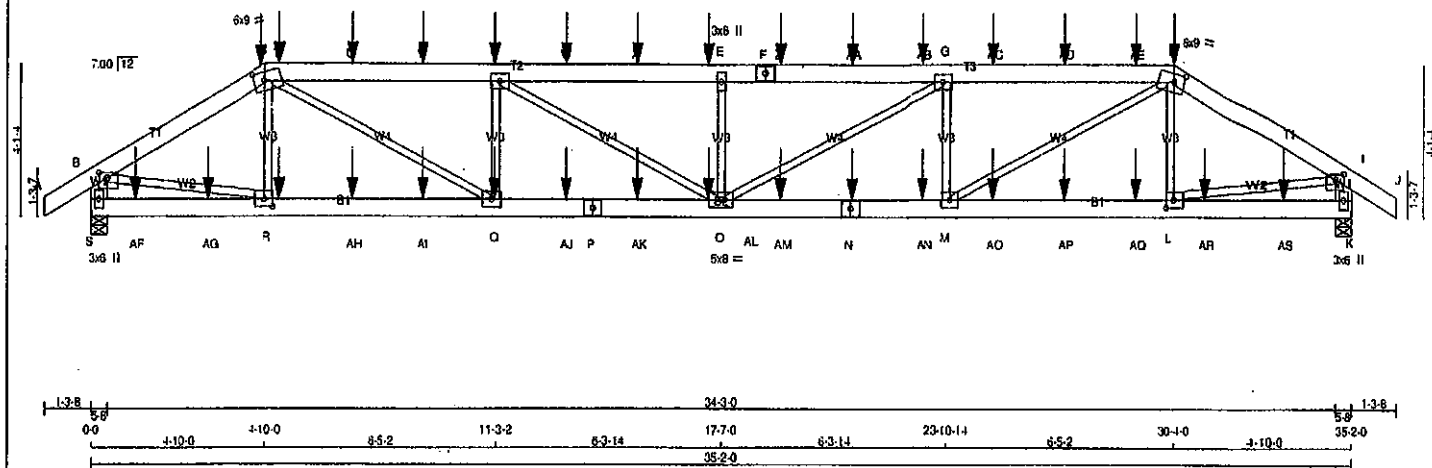

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x6	DRY	No.2	SPF
C - F	2x6	DRY	No.2	SPF
F - H	2x6	DRY	No.2	SPF
H - J	2x6	DRY	No.2	SPF
J - L	2x6	DRY	No.2	SPF
L - N	2x6	DRY	No.2	SPF
N - K	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	SIDE(122.0)
C - F	12	SIDE(183.1)
F - H	12	SIDE(61.0)
H - J	12	SIDE(122.0)
J - L	12	TOP
L - N	12	TOP
N - K	12	SIDE(183.1)
ALL CHORDS : (0.122"x3") SPIRAL NAILS		
P - N	12	SIDE(0.0)
N - K	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REQD
JT	VERT	DOWN	UP	BRG
S	3423	0	0	5-8
K	3365	0	0	5-8

UNFACTORED REACTIONS	1ST LOOSE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
S	2418	1600	0	0	0	0
K	2378	1573	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.03 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO									
A-B	0	33	-91.8	-91.8	0.04 (1)	10.00	R-C	-431	9
B-C	-4681	0	-91.8	-91.8	0.13 (1)	5.23	C-Q	0	3534
C-T	-7102	0	-91.8	-91.8	0.31 (1)	4.26	Q-D	-1555	0
T-U	-7102	0	-91.8	-91.8	0.31 (1)	4.26	D-O	0	1048
U-V	-7102	0	-91.8	-91.8	0.31 (1)	4.26	O-E	-884	0
V-W	-7102	0	-91.8	-91.8	0.31 (1)	4.26	E-G	0	1065
W-X	-8010	0	-91.8	-91.8	0.32 (1)	4.05	M-H	-1573	0
X-Y	-8010	0	-91.8	-91.8	0.32 (1)	4.05	H-I	0	3572
Y-E	-8010	0	-91.8	-91.8	0.32 (1)	4.05	B-R	0	4088
E-F	-8010	0	-91.8	-91.8	0.33 (1)	4.03	L-I	0	4022
F-Z	-8010	0	-91.8	-91.8	0.33 (1)	4.03			
Z-AA	-8010	0	-91.8	-91.8	0.33 (1)	4.03			
AA-AB	-8010	0	-91.8	-91.8	0.33 (1)	4.03			
AB-G	-8010	0	-91.8	-91.8	0.33 (1)	4.03			
G-AC	-7070	0	-91.8	-91.8	0.30 (1)	4.27			
AC-AD	-7070	0	-91.8	-91.8	0.30 (1)	4.27			
AD-AE	-7070	0	-91.8	-91.8	0.30 (1)	4.27			
AE-H	-7070	0	-91.8	-91.8	0.30 (1)	4.27			
H-I	-4606	0	-91.8	-91.8	0.13 (1)	5.28			
I-J	0	33	-91.8	-91.8	0.04 (1)	10.00			
J-S	-3367	0	0	0	0.12 (1)	7.58			
K-I	-3318	0	0	0	0.12 (1)	7.63			

S-AF	0	0	-18.5	-18.5	0.06 (4)	10.00
AF-AG	0	0	-18.5	-18.5	0.06 (4)	10.00
AG-R	0	0	-18.5	-18.5	0.06 (4)	10.00
RA-H	0	4024	-18.5	-18.5	0.31 (1)	10.00
HA-AI	0	4024	-18.5	-18.5	0.31 (1)	10.00
AI-O	0	4024	-18.5	-18.5	0.31 (1)	10.00
O-AJ	0	7102	-18.5	-18.5	0.52 (1)	10.00
AJ-P	0	7102	-18.5	-18.5	0.52 (1)	10.00
P-AK	0	7102	-18.5	-18.5	0.52 (1)	10.00
AK-AL	0	7102	-18.5	-18.5	0.52 (1)	10.00
AL-O	0	7102	-18.5	-18.5	0.52 (1)	10.00
O-AM	0	7070	-18.5	-18.5	0.52 (1)	10.00
AM-N	0	7070	-18.5	-18.5	0.52 (1)	10.00
N-AN	0	7070	-18.5	-18.5	0.52 (1)	10.00
AN-M	0	7070	-18.5	-18.5	0.52 (1)	10.00
MAO	0	3960	-18.5	-18.5	0.30 (1)	10.00
AO-AP	0	3960	-18.5	-18.5	0.30 (1)	10.00
AP-AQ	0	3960	-18.5	-18.5	0.30 (1)	10.00
AQ-L	0	3960	-18.5	-18.5	0.30 (1)	10.00

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
BOT CH. LL = 0.0 PSF
DL = 0.0 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.0/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, NBCC 2015, ABC 2010
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.20")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.37")

CS: TC=0.33/1.00 (E-G:1) , BC=0.52/1.00 (O-Q:1) ,
WB=0.51/1.00 (B-R:1) , SS=0.18/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (Q) (INPUT = 0.90)
JSI METAL= 0.68 (P) (INPUT = 1.00)

CONTINUED ON PAGE 2



Structural component only
DWG# T-2007632 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T20	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:02 2020 Page 2

ID:DMCubINVR6TsFoe31v6l zns1l-x73EqNd7IXbU6seccoDbPaw0PaBNFZ7YIB c8zMEMh

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.75	2.75
C	TTWW-m	MT20	6.0	9.0	2.75	3.50
D	TMVW-t	MT20	5.0	8.0		
E	TMVW-w	MT20	3.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMVW-t	MT20	5.0	6.0		
H	TTWW-m	MT20	6.0	9.0	2.75	3.50
I	TMVW-p	MT20	5.0	6.0	1.75	2.75
K	BMV1-p	MT20	3.0	6.0		
L	BMVW-t	MT20	5.0	6.0	2.50	2.75
M	BMVW-t	MT20	5.0	6.0		
N	BS-t	MT20	5.0	6.0		
O	BMVW-t	MT20	5.0	6.0		
P	BS-t	MT20	5.0	6.0		
Q	BMVW-t	MT20	5.0	6.0		
R	BMVW-t	MT20	5.0	6.0	2.50	2.75
S	BMV1-p	MT20	3.0	6.0		

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. MEMB. FORCE (LBS)	MAX. FACTORED UNBRAC. LENGTH	FR-TO	
FR-TO		FROM	TO				
L-AR	0 0	-18.5	-18.5	0.06 (4)	10.00		
AR-AS	0 0	-18.5	-18.5	0.06 (4)	10.00		
AS-K	0 0	-18.5	-18.5	0.06 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-10-0	-80	-67	---	FRONT	VERT	DEAD	---	C1
C	4-10-0	-311	-311	---	FRONT	VERT	SNOW	---	C1
D	11-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	30-4-0	-60	-67	---	FRONT	VERT	DEAD	---	C1
H	30-4-0	-311	-311	---	FRONT	VERT	SNOW	---	C1
N	21-2-12	-28	-26	---	FRONT	VERT	TOTAL	---	C1
Q	11-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
R	5-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
T	5-2-12	-138	-138	---	FRONT	VERT	TOTAL	---	C1
U	7-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	9-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	13-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	15-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	17-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	19-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	21-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	29-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	1-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	3-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AH	7-2-12	-28	-26	---	FRONT	VERT	TOTAL	---	C1
AI	9-2-12	-26	-28	---	FRONT	VERT	TOTAL	---	C1
AJ	13-2-12	-28	-26	---	FRONT	VERT	TOTAL	---	C1
AK	15-2-12	-28	-26	---	FRONT	VERT	TOTAL	---	C1
AL	17-2-12	-28	-26	---	FRONT	VERT	TOTAL	---	C1
AM	19-2-12	-26	-28	---	FRONT	VERT	TOTAL	---	C1
AN	23-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AO	25-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AP	27-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AO	29-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AR	31-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AS	33-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007632

JOB NAME 408223	TRUSS NAME T21	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Famarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:04:03 2020 Page 1
ID:DMCubINVR6t5lF0e31v6l zns1l-PKdcjelUqilK0D3AWlqx0T6J Wk xSi yxX9bzMEMg
Scale = 1:57.6

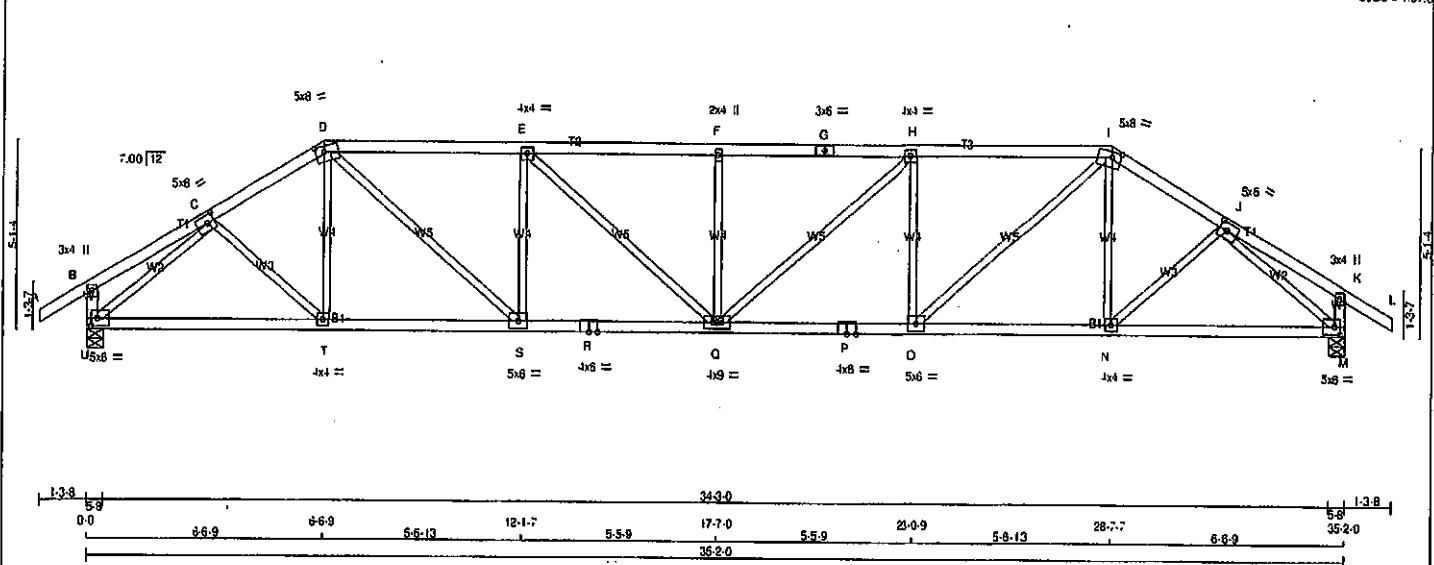

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY No.2	SPF
D - G	2x4	DRY No.2	SPF
G - I	2x4	DRY No.2	SPF
I - L	2x4	DRY No.2	SPF
U - B	2x4	DRY No.2	SPF
M - K	2x4	DRY No.2	SPF
U - R	2x4	DRY No.2	SPF
R - P	2x4	DRY No.2	SPF
P - M	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			
DRY, SEASONED LUMBER			

PLATES (Table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMV+p	MT20	3.0	4.0	
C TMWW-i	MT20	5.0	8.0	2.50 2.50
D TTWW-m	MT20	5.0	8.0	1.75 3.00
E TMWW-i	MT20	4.0	4.0	
F TMWW-w	MT20	2.0	4.0	
G TS-i	MT20	3.0	6.0	
H TMWW-i	MT20	4.0	4.0	
I TTWW-m	MT20	5.0	8.0	1.75 3.00
J TMWW-i	MT20	5.0	8.0	2.50 2.50
K TMV+p	MT20	3.0	4.0	
M BMVW-i	MT20	5.0	8.0	2.50 2.00
N BMWW-i	MT20	4.0	4.0	
O BMWW-i	MT20	5.0	8.0	
P BS-i	MT20	4.0	6.0	
Q BMWWW-i	MT20	4.0	8.0	
R BS-i	MT20	4.0	6.0	
S BMWW-i	MT20	5.0	8.0	
T BMWW-i	MT20	4.0	4.0	
U BMVW-i	MT20	5.0	8.0	2.50 2.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
	FACTORED	MAXIMUM FACTORED	INPUT	RECORD					
	GROSS REACTION	GROSS REACTION	BRG	BRG					
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
JT	2064	0	2064	0	0	5-8	5-8		
U	2064	0	2064	0	0	5-8	5-8		
M	2064	0	2064	0	0	5-8	5-8		
UNFACTORED REACTIONS									
1ST CASE	MAX	MIN	COMPONENT	REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
U	1457	970	0	0	0	0	0		
M	1457	970	0	0	0	0	0		
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M									
BRACING									
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.12 FT.									
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.									
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.									
LOADING									
TOTAL LOAD CASES: (4)									

CHORDS					WEBS				
MEMB.	MAX. FACTORED	FACTORED	MAX.	UNBRAC	MEMB.	MAX. FACTORED	MAX.	UNBRAC	MEMB.
	FORCE	VERT. LOAD	LC1	MAX		FORCE	MAX	UNBRAC	
	(LBS)	(PLF)	(LC)	(LC)		(LBS)	(LC)	(LC)	
FR-TO		FROM	TO	LENGTH	FR-TO		FROM	TO	LENGTH
A-B	0 32	-91.8	-91.8	0.12 (1)	10.00	C-T	0 213	0.05 (1)	
B-C	0 13	-91.8	-91.8	0.12 (1)	10.00	T-D	-8 89	0.02 (1)	
C-D	-2527 0	-91.8	-91.8	0.20 (1)	4.18	D-S	0 1447	0.33 (1)	
D-E	-3264 0	-91.8	-91.8	0.66 (1)	3.30	S-E	-853 0	0.33 (1)	
E-F	-3585 0	-91.8	-91.8	0.70 (1)	3.12	E-Q	0 428	0.10 (1)	
F-G	-3585 0	-91.8	-91.8	0.70 (1)	3.12	Q-F	-492 0	0.18 (1)	
G-H	-3585 0	-91.8	-91.8	0.70 (1)	3.12	Q-H	0 428	0.10 (1)	
H-I	-3264 0	-91.8	-91.8	0.66 (1)	3.30	O-H	-853 0	0.33 (1)	
I-J	-2527 0	-91.8	-91.8	0.20 (1)	4.18	O-I	0 1447	0.33 (1)	
J-K	0 13	-91.8	-91.8	0.12 (1)	10.00	N-I	-8 69	0.02 (1)	
K-L	0 32	-91.8	-91.8	0.12 (1)	10.00	N-J	0 213	0.05 (1)	
U-B	-249 0	0.0	0.0	0.03 (1)	7.81	U-C	-2671 0	0.82 (1)	
M-K	-249 0	0.0	0.0	0.03 (1)	7.81	J-M	-2671 0	0.82 (1)	
U-T	0 2005	-18.5	-18.5	0.42 (1)	10.00				
T-S	0 2187	-18.5	-18.5	0.44 (1)	10.00				
S-R	0 3264	-18.5	-18.5	0.58 (1)	10.00				
R-Q	0 3264	-18.5	-18.5	0.58 (1)	10.00				
Q-P	0 3264	-18.5	-18.5	0.58 (1)	10.00				
P-O	0 3264	-18.5	-18.5	0.58 (1)	10.00				
O-N	0 2187	-18.5	-18.5	0.44 (1)	10.00				
N-M	0 2005	-18.5	-18.5	0.42 (1)	10.00				


DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF
SPACING = 24.0 IN. C/C	
LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00x12	
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCO 2010, NBCC 2015	
THIS DESIGN COMPLIES WITH:	
- PART 9 OF CBC 2018, CBC 2012, ABC 2019	
- PART 9 OF CBC 2012 (2019 AMENDMENT)	
- CSA 086-09, CSA 088-14	
- TPIC 2011, TPIC 2014	
155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD	
ALLOWABLE DEFL.(LL) = L/360 (1.17")	
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")	
ALLOWABLE DEFL.(TL) = L/360 (1.17")	
CALCULATED VERT. DEFL.(TL) = L/999 (0.39")	
CS: TC=0.70x1.00 (E-F:1), BC=0.58x1.00 (Q-S:1), WB=0.82x1.00 (J-M:1), SS=0.24x1.00 (D-E:1)	
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10	
COMPANION LIVE LOAD FACTOR = 1.00	

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.	
NAIL VALUES	
PLATE GRIP (DRY) SHEAR SECTION	
(PSI) (PLI)	
MAX MIN MAX MIN MAX MIN	
MT20 818 354 1687 788 1987 1658	
PLATE PLACEMENT TOL. = 0.250 inches	
PLATE ROTATION TOL. = 5.0 Deg.	
JSI GRIP = 0.90 (M) (INPUT = 0.90)	
JSI METAL = 0.74 (R) (INPUT = 1.00)	



Structural component only
DWG# T-2007633

JOB NAME 408223	TRUSS NAME T22	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:04:04 2020 Page 1	
ID:DMCubINVR8TstFoe31v6l zns11-WB743eNF8rCMAoFJOG3U?0GFOtITrCeg4h1zMEMI				352-0 385-8 1-3-8	
1-3-8 0-0 4-2-13 4-2-13 4-0-5 3-3-2 6-3-0 14-6-2 6-1-12 20-7-14 6-3-0 26-10-14 4-0-5 30-11-3 4-2-13 352-0				Scale = 1:57.6	

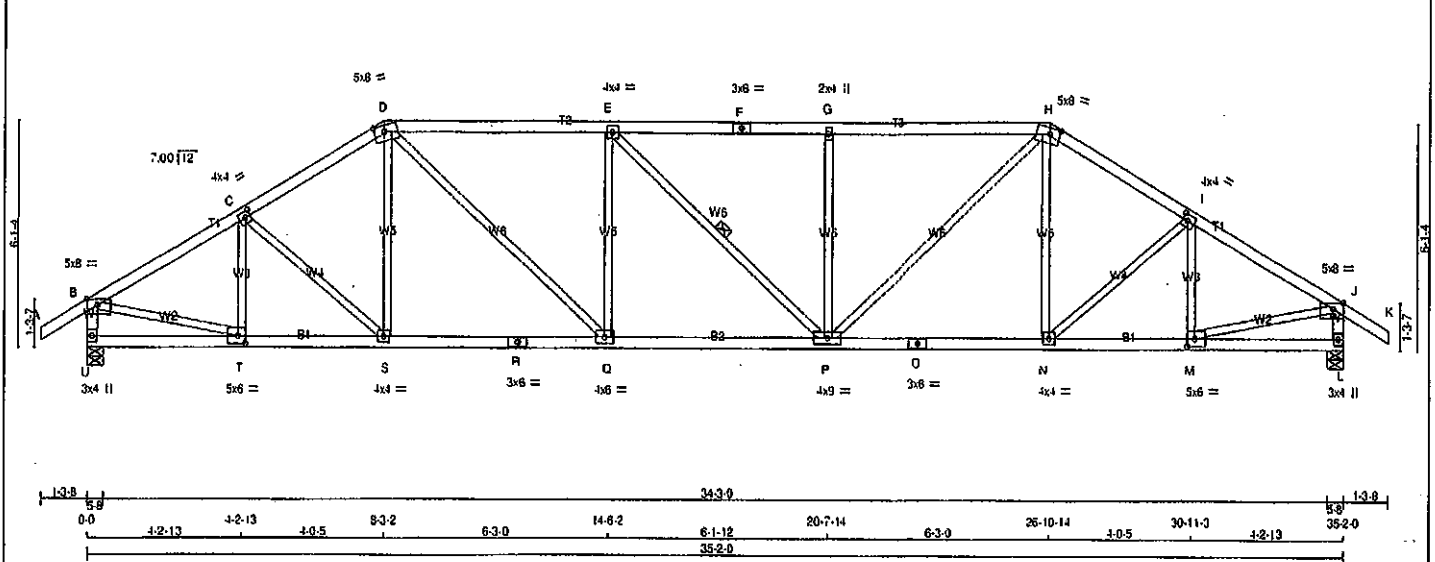

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
U - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (Table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMW-p	MT20	5.0	8.0 Edge 3.50
C	TMW-1	MT20	4.0	4.0 2.00 1.75
D	TTW-m	MT20	5.0	8.0 2.00 3.50
E	TMW-1	MT20	4.0	4.0 Edge 3.50
F	TS-1	MT20	3.0	8.0
G	TMW-1	MT20	2.0	4.0
H	TTW-m	MT20	5.0	8.0 2.00 3.50
I	TMW-1	MT20	4.0	4.0 2.00 1.75
J	TMW-p	MT20	5.0	8.0 Edge 3.50
L	BMW-1-p	MT20	3.0	4.0
M	BMW-1	MT20	5.0	8.0 2.50 2.50
N	BMW-1	MT20	4.0	4.0
O	BS-1	MT20	3.0	8.0
P	BMW-1	MT20	4.0	9.0
Q	BMW-1	MT20	4.0	8.0
R	BS-1	MT20	3.0	8.0
S	BMW-1	MT20	4.0	4.0
T	BMW-1	MT20	5.0	8.0 2.50 2.50
U	BMW-1-p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
U	2084	0	2084	0	0	5-8	5-8	5-8	5-8
L	2084	0	2084	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	DEAD	SOIL
U	1457	970	0	0	0	0	0	488	0
L	1457	970	0	0	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.37 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FORCE (LBS)	MAX. CS1 (LC)	MAX. CS1 (LC)
FR-TO		FROM TO		FR-TO			
A-B	0 32	-91.8 -91.8 0.12 (1)	10.00	T-C	-428 0	0.10 (1)	0.10 (1)
B-C	-2468 0	-91.8 -91.8 0.35 (1)	4.07	C-S	-39 0	0.02 (1)	0.02 (1)
C-D	-2478 0	-91.8 -91.8 0.34 (1)	4.08	S-D	0 131	0.04 (4)	0.04 (4)
D-E	-2910 0	-91.8 -91.8 0.75 (1)	3.37	D-Q	0 1075	0.24 (1)	0.24 (1)
E-F	-2809 0	-91.8 -91.8 0.74 (1)	3.38	Q-E	-617 0	0.36 (1)	0.36 (1)
F-G	-2809 0	-91.8 -91.8 0.74 (1)	3.38	E-P	-2 0	0.00 (1)	0.00 (1)
G-H	-2809 0	-91.8 -91.8 0.75 (1)	3.38	P-G	-617 0	0.36 (1)	0.36 (1)
H-I	-2478 0	-91.8 -91.8 0.34 (1)	4.06	P-H	0 1073	0.24 (1)	0.24 (1)
I-J	-2468 0	-91.8 -91.8 0.35 (1)	4.07	H-N	0 132	0.04 (4)	0.04 (4)
J-K	0 32	-91.8 -91.8 0.12 (1)	10.00	N-I	-39 0	0.02 (1)	0.02 (1)
U-B	-2025 0	0.0 0.0 0.21 (1)	5.94	M-I	-428 0	0.10 (1)	0.10 (1)
L-J	-2025 0	0.0 0.0 0.21 (1)	5.94	B-T	0 2205	0.50 (1)	0.50 (1)
U-T	0 0	-18.5 -18.5 0.07 (4)	10.00	M-J	0 2205	0.50 (1)	0.50 (1)
T-S	0 2149	-18.5 -18.5 0.41 (1)	10.00				
S-R	0 2122	-18.5 -18.5 0.41 (1)	10.00				
R-Q	0 2122	-18.5 -18.5 0.41 (1)	10.00				
Q-P	0 2910	-18.5 -18.5 0.54 (1)	10.00				
P-O	0 2122	-18.5 -18.5 0.41 (1)	10.00				
O-N	0 2122	-18.5 -18.5 0.41 (1)	10.00				
N-M	0 2149	-18.5 -18.5 0.41 (1)	10.00				
M-L	0 0	-18.5 -18.5 0.07 (4)	10.00				

TOTAL WEIGHT = 146 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL (LL) = L/360 (1.17")
CALCULATED VERT. DEFL (LL) = L/999 (0.16")
ALLOWABLE DEFL (TL) = L/360 (1.17")
CALCULATED VERT. DEFL (TL) = L/999 (0.30")

CSK: TC=0.75/1.00 (D-E-1), EC=0.54/1.00 (P-Q-1), WB=0.50/1.00 (B-T-1), SS=0.27/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 610 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.89 (T) (INPUT = 0.90)
JSI METAL = 0.70 (O) (INPUT = 1.00)

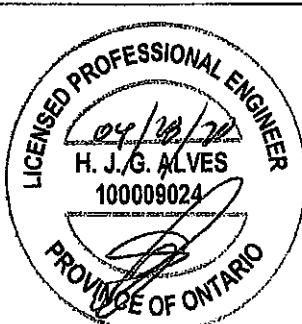

Structural component only
DWG# T-2007634

JOB NAME 408223	TRUSS NAME T23	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Tue Apr 28 10:04:06 2020 Page 1
 ID:DMCubINVR6TslFoe31vbl zns11-pwJIVkgeml5wbUyerelXZQ5aqCaVBjG8gw9BlvzMEMd
 35-2-0 35-5-8 1-3-8
 Scale = 1:57.6

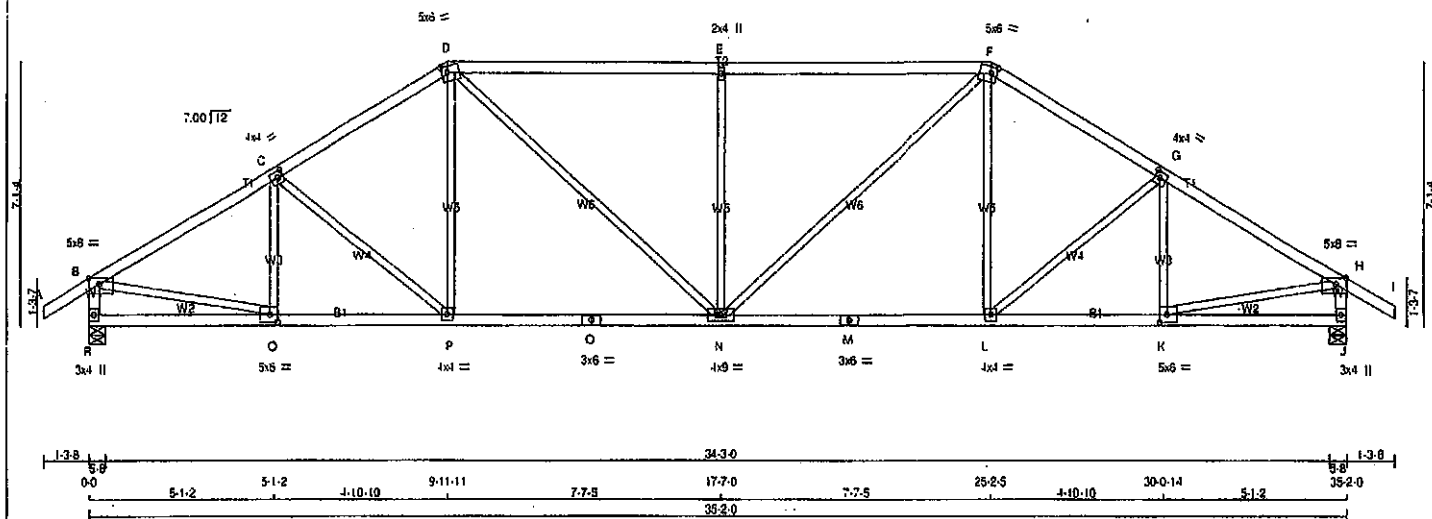

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - B	2x4	DRY	No.2
B - H	2x4	DRY	No.2
H - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)			
JT TYPE	PLATES	W	LEN Y X
B TMVW-p	MT20	5.0	8.0 Edge 3.50
C TMVW-t	MT20	4.0	4.0 2.00 1.75
D TTWW-m	MT20	5.0	8.0 2.00 2.00
E TMVW-w	MT20	2.0	4.0
F TTWW-m	MT20	5.0	8.0 2.00 2.00
G TMVW-t	MT20	4.0	4.0 2.00 1.75
H TMVW-p	MT20	5.0	8.0 Edge 3.50
J BMVt-p	MT20	3.0	4.0
K BMVW-t	MT20	5.0	8.0 2.50 2.50
L BMVW-t	MT20	4.0	4.0
M BS-t	MT20	3.0	6.0
N BMVW-t	MT20	4.0	9.0
O BS-t	MT20	3.0	6.0
P BMVW-t	MT20	4.0	4.0
Q BMVW-t	MT20	5.0	8.0 2.50 2.50
R BMVt-p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT REQD BRG
R	2064 0	2064 0	5-8
J	2064 0	2064 0	5-8

UNFACTORED REACTIONS			
JT	1ST LOASE COMBINED	MAX. MIN. SNOW LIVE	PERM. LIVE WIND DEAD SOIL
R	1457	970 0	0 0 0 0 0 0
J	1457	970 0	0 0 0 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.16 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)
FR-TO			
A-B	0 32	-91.8 -91.8	10.00
B-C	-2537 0	-91.8 -91.8	4.00
C-D	-2388 0	-91.8 -91.8	4.11
D-E	-2609 0	-91.8 -91.8	3.16
E-F	-2609 0	-91.8 -91.8	3.16
F-G	-2396 0	-91.8 -91.8	4.11
G-H	-2537 0	-91.8 -91.8	4.00
H-I	0 32	-91.8 -91.8	10.00
I-J	-2020 0	0.0 0.0	5.94
J-H	-2020 0	0.0 0.0	5.94
R-Q	0 0	-18.5 -18.5	10.00
Q-P	0 2213	-18.5 -18.5	10.00
P-O	0 2048	-18.5 -18.5	10.00
O-N	0 2048	-18.5 -18.5	10.00
N-M	0 2048	-18.5 -18.5	10.00
M-L	0 2048	-18.5 -18.5	10.00
L-K	0 2213	-18.5 -18.5	10.00
K-J	0 0	-18.5 -18.5	10.00

WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. UNBRACED LENGTH (FT)
FR-TO			
D-C	-335 0	0.09 (1)	
C-P	-216 0	0.16 (1)	
P-D	0 258	0.08 (4)	
D-N	0 752	0.17 (1)	
N-E	-860 0	0.75 (1)	
E-F	0 752	0.17 (1)	
F-L	0 258	0.06 (4)	
L-G	-216 0	0.16 (1)	
G-Q	-335 0	0.09 (1)	
Q-G	0 2253	0.51 (1)	
K-H	0 2253	0.51 (1)	

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.8 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.13")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.27")

CSI: TC=0.88/1.00 (E-F:1), BC=0.45/1.00 (K-L:1),
 WB=0.75/1.00 (E-N:1), SS=0.34/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (K) (INPUT = 0.90)
 JSI METAL= 0.72 (M) (INPUT = 1.00)




Structural component only
 DWG# T-2007635

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T24	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 \$ Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:04:07 2020 Page 1

ID:DMCubINV8Rt5f0e31v6l_zns11-H5s74hGX3DnDaWqPLm6eepobw_wk9HuaVKIMzMEMC



LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR	
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
R - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
R - O	2x4	DRY	No.2	SPF
O - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
DRY: SEASONED LUMBER.				

PLATES (table is in inches)	PLATES	W	LEN	Y	X
B	TMW-p	MT20	5.0	8.0	Edge 3.50
C	TMW-w	MT20	4.0	4.0	2.00 1.75
D	TTWW-m	MT20	5.0	6.0	2.25 2.00
E	TMW-w	MT20	2.0	4.0	
F	TTWW-m	MT20	5.0	6.0	2.25 2.00
G	TMW-w	MT20	4.0	4.0	2.00 1.75
H	TMW-p	MT20	5.0	8.0	Edge 3.50
J	BMVt-p	MT20	3.0	4.0	
K	BMW-w	MT20	5.0	6.0	2.50 2.50
L	BMW-w	MT20	4.0	4.0	
M	BS-t	MT20	3.0	8.0	
N	BMW-w	MT20	4.0	4.0	
O	BS-t	MT20	3.0	8.0	
P	BMW-w	MT20	4.0	4.0	
Q	BMW-w	MT20	5.0	6.0	2.50 2.50
R	BMVt-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORZ	BRG	BRG	IN-SX	IN-SX
R	2084	0	2084	0	0	5-8	5-8		
J	2084	0	2084	0	0	5-8	5-8		

UNFACTORED REACTIONS							
1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1457	970 0	0 0	0 0	0 0	488 0	0 0
J	1457	970 0	0 0	0 0	0 0	488 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.81 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: [4]									
CHORDS				WEBS					
MAX. FACTORED		FACTORED		MAX.		MAX. FACTORED		MAX.	
MEMB.	FORCE	VERT. LOAD	LC1	MAX	MAX.	MEMB.	FORCE	MAX	MAX
	(LBS)	(PLF)	CSI(LC)	CSI(LC)	UNBRAC		(LBS)	CSI(LC)	CSI(LC)
FR-TO		FROM TO			LENGTH	FR-TO			
A-B	0 32	-91.8 -91.8	0.12 (1)	10.00	Q-C	-252 12	0.08 (1)		
B-C	-2575 0	-91.8 -91.8	0.54 (1)	3.81	C-P	-389 0	0.41 (1)		
C-D	-2263 0	-91.8 -91.8	0.50 (1)	4.05	P-D	0 345	0.08 (1)		
D-E	-2236 0	-91.8 -91.8	0.49 (1)	4.08	D-N	0 480	0.11 (1)		
E-F	-2236 0	-91.8 -91.8	0.49 (1)	4.08	N-E	-682 0	0.84 (1)		
F-G	-2263 0	-91.8 -91.8	0.50 (1)	4.05	N-F	0 480	0.11 (1)		
G-H	-2575 0	-91.8 -91.8	0.54 (1)	3.81	L-F	0 345	0.08 (1)		
H-I	0 32	-91.8 -91.8	0.12 (1)	10.00	L-G	-389 0	0.41 (1)		
R-B	-2016 0	0.0 0.0	0.21 (1)	5.94	K-G	-252 12	0.08 (1)		
J-H	-2016 0	0.0 0.0	0.21 (1)	5.94	B-Q	0 2281	0.51 (1)		
					K-H	0 2281	0.51 (1)		
R-Q	0 0	-18.5 -18.5	0.14 (4)	10.00					
Q-P	0 2251	-18.5 -18.5	0.43 (1)	10.00					
P-O	0 1947	-18.5 -18.5	0.38 (1)	10.00					
O-N	0 1947	-18.5 -18.5	0.38 (1)	10.00					
N-M	0 1947	-18.5 -18.5	0.38 (1)	10.00					
M-L	0 1947	-18.5 -18.5	0.38 (1)	10.00					
L-K	0 2251	-18.5 -18.5	0.43 (1)	10.00					
K-J	0 0	-18.5 -18.5	0.14 (4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
OL = 6.0 PSF
BOT CH. LL = 0.0 PSF
OL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")
CS: TC=0.54/1.00 (B-C:1), BC=0.43/1.00 (P-Q:1), WB=0.84/1.00 (E-N:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 L.S BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (Q) INPUT = 0.90
JSI METAL= 0.61 (M) INPUT = 1.00



Structural component only
DWG# T-2007636


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T25	4	1	GREEN PARK HOMES	
TRUSS DESC.					

Famarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:04:08 2020 Page 1

ID:DMCubINVR6TsiFoe31vbl zns11HQVwChuiNMdm50y3K7erAxP7FIGSR7DeIqozMEMb

1-3-8 0-0 8-9-11 9-9-11 2-7-3 13-4-14 4-2-2 17-7-0 21-9-2 6-7-3 28-4-5 6-9-11 35-2-0 1-3-8
Scale = 1:50.3

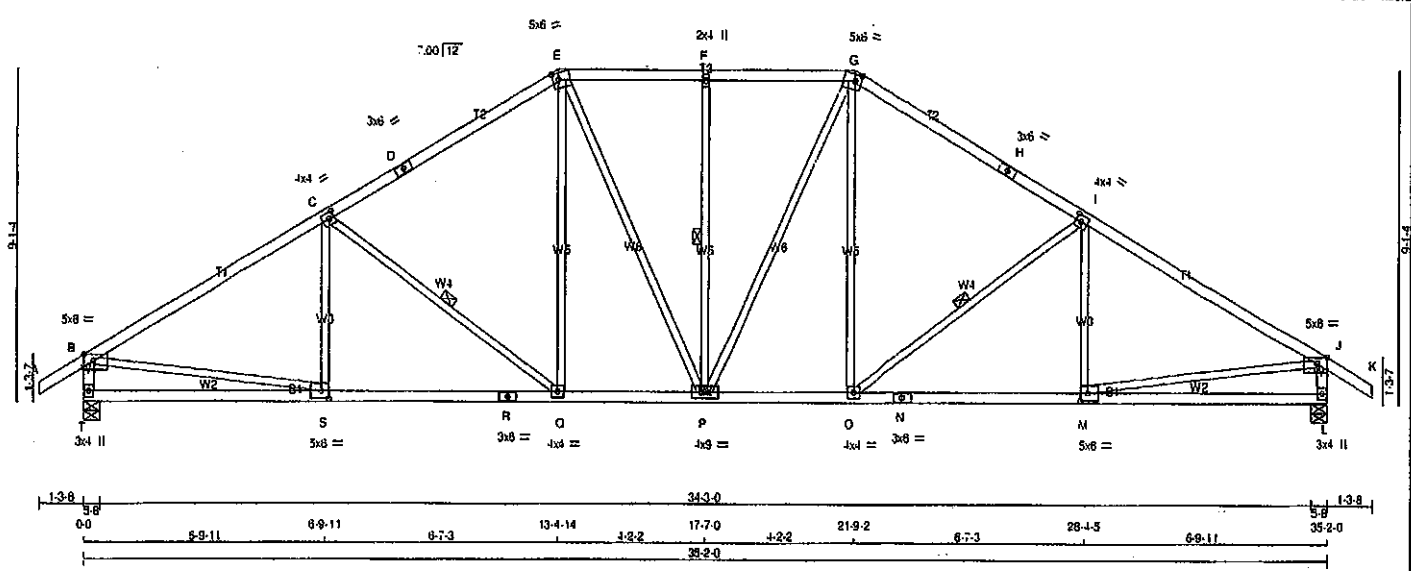

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - J	2x4	DRY	No.2
T - R	2x4	DRY	No.2
R - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	8.9	Edge	3.50
C TMVW-t	MT20	4.0	4.0	2.00	1.75
D TS-1	MT20	3.0	6.0		
E TTWW-m	MT20	5.0	6.0	2.25	2.00
F TMW-w	MT20	2.0	4.0		
G TTWW-m	MT20	5.0	6.0	2.25	2.00
H TS-1	MT20	3.0	6.0		
I TMVW-t	MT20	4.0	4.0	2.00	1.75
J TMVW-p	MT20	5.0	8.9	Edge	3.50
L BMV-t	MT20	3.0	4.0		
M BMVW-t	MT20	5.0	6.0	2.50	2.50
N BS-1	MT20	3.0	6.0		
O BMVW-t	MT20	4.0	4.0		
P BMVW-t	MT20	4.0	4.0		
Q BMVW-t	MT20	4.0	4.0		
R BS-1	MT20	3.0	6.0		
S BMVW-t	MT20	5.0	6.0	2.50	2.50
T BMV-t	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED	MAXIMUM FACTORED	INPUT	RECORD	
	GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	DOWN	UPLIFT	IN-SX
T	2084	0	2084	0	5-8
L	2084	0	2084	0	5-8

UNFACTORED REACTIONS					
	1ST LCASE	MAX. MIN.	COMPONENT REACTIONS		
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
T	1457	970	0	0	0
L	1457	970	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.54 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1:2 LENGTH OF C-Q, F-P, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED BY THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 32	-91.8 -91.8 0.12 (1)	10.00	S-C	-185 51	0.08 (1)	
B-C	-2590 0	-91.8 -91.8 0.74 (1)	3.54	C-Q	-548 0	0.26 (1)	
C-D	-2156 0	-91.8 -91.8 0.68 (1)	3.91	Q-E	0 431	0.10 (1)	
D-E	-2156 0	-91.8 -91.8 0.68 (1)	3.91	E-P	0 286	0.08 (1)	
E-F	-1956 0	-91.8 -91.8 0.24 (1)	4.61	P-F	-480 0	0.25 (1)	
F-G	-1956 0	-91.8 -91.8 0.24 (1)	4.61	F-G	0 286	0.06 (1)	
G-H	-2156 0	-91.8 -91.8 0.68 (1)	3.91	O-G	0 431	0.10 (1)	
H-I	-2156 0	-91.8 -91.8 0.68 (1)	3.91	O-I	-548 0	0.26 (1)	
I-J	-2590 0	-91.8 -91.8 0.74 (1)	3.54	M-I	-185 51	0.08 (1)	
J-K	0 32	-91.8 -91.8 0.12 (1)	10.00	B-S	0 2292	0.52 (1)	
T-B	-2011 0	0.0 0.0 0.20 (1)	5.95	M-J	0 2292	0.52 (1)	
L-J	-2011 0	0.0 0.0 0.20 (1)	5.95				
T-S	0 0	-18.5 -18.5 0.20 (4)	10.00				
S-R	0 2269	-18.5 -18.5 0.46 (1)	10.00				
R-Q	0 2269	-18.5 -18.5 0.46 (1)	10.00				
Q-P	0 1833	-18.5 -18.5 0.38 (1)	10.00				
P-O	0 1833	-18.5 -18.5 0.38 (1)	10.00				
O-N	0 2269	-18.5 -18.5 0.46 (1)	10.00				
N-M	0 2269	-18.5 -18.5 0.46 (1)	10.00				
M-L	0 0	-18.5 -18.5 0.20 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 26.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN. O/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CSK TC=0.74/1.00 (J-J), BC=0.46/1.00 (M-O), WB=0.52/1.00 (J-M), SS=0.26/1.00 (J-J)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (SI) INPUT = 0.90
JSI METAL= 0.89 (IN) INPUT = 1.00

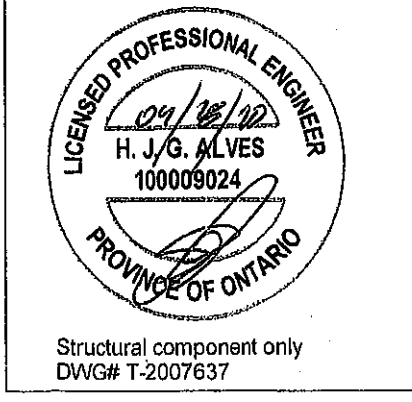


Structural component only
DWG# T-2007637

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:04:09 2020 Page 1

ID:DMCubINVR6T3F0e31v6l zns11-DU .u8miW3gUUSxgCWmsEB3j6iPbBOjwaMtOrMEzMEMa

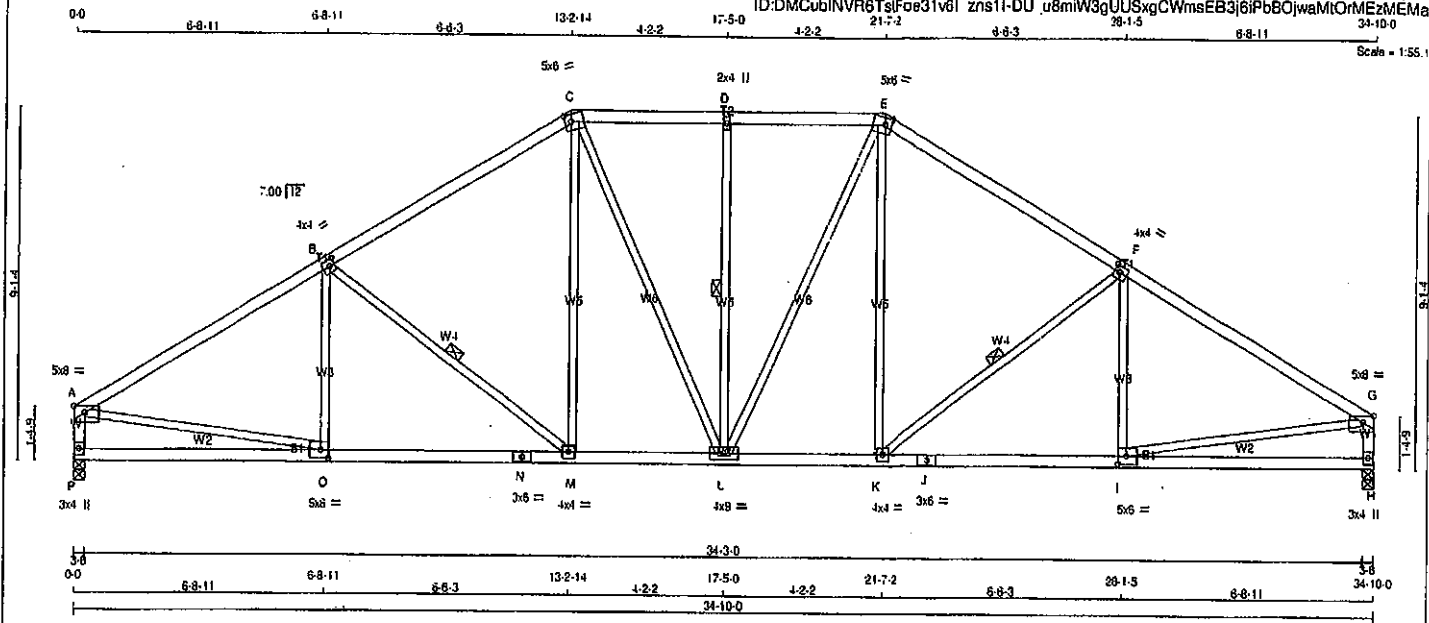

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
P - A	2x4	DRY	No.2
H - G	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-p	MT20	5.0	8.0	2.00	Edge
B	TMWW-1	MT20	4.0	4.0	2.00	1.75
C	TTWW-m	MT20	5.0	8.0	2.25	2.00
D	TMW-w	MT20	2.0	4.0		
E	TTWW-m	MT20	5.0	8.0	2.25	2.00
F	TMWW-1	MT20	4.0	4.0	2.00	1.75
G	TMVW-p	MT20	5.0	8.0	Edge	3.50
H	BMV1-p	MT20	3.0	4.0		
I	BMWW-1	MT20	5.0	8.0	2.50	2.50
J	BS-1	MT20	3.0	6.0		
K	BMWW-1	MT20	4.0	4.0		
L	BMWWW-1	MT20	4.0	9.0		
M	BMWW-1	MT20	4.0	4.0		
N	BS-1	MT20	3.0	6.0		
O	BMWW-1	MT20	5.0	8.0	2.50	2.50
P	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT VERT	1920	0	0	0
P VERT	1920	0	0	0
H VERT	1920	0	0	0

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	SNOW
P	1358 891 0 0 0 0 0 0 0 0 0 0
H	1358 891 0 0 0 0 0 0 0 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.84 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1:2 LENGTH OF B-M, D-L, F-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLP)	MAX. UNBRACED LENGTH (L)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (L)	CS(L/C)
FR-TO				FR-TO			
A-B	-2510	0	91.8	0-8	-212	40	0.09 (1)
B-C	-2113	0	91.8	8-11	-510	0	0.24 (1)
C-D	-1919	0	91.8	11-14	0	412	0.09 (1)
D-E	-1919	0	91.8	14-17	0	287	0.06 (1)
E-F	-2113	0	91.8	17-20	-461	0	0.25 (1)
F-G	-2510	0	91.8	20-23	0	287	0.06 (1)
P-A	-1868	0	0.0	0-1	0	412	0.09 (1)
H-G	-1868	0	0.0	1-4	-510	0	0.24 (1)
P-O	0	0	-18.5	4-7	-212	40	0.09 (1)
O-N	0	2199	-18.5	7-10	0	2227	0.50 (1)
N-M	0	2199	-18.5	10-13	0	2227	0.50 (1)
M-L	0	1797	-18.5	13-16	0	1000	
L-K	0	1797	-18.5	16-19	0	1000	
K-J	0	2199	-18.5	19-22	0	1000	
J-I	0	2199	-18.5	22-25	0	1000	
I-H	0	0	-18.5	25-28	0	1000	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G.C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.21")
CSI: TC=0.71 1.00 (A-B:1), BC=0.45 1.00 (M-O:1), WB=0.50 1.00 (A-C:1), SS=0.26 1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1887 788 1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.84 (1) (INPUT = 0.90)
JSI METAL = 0.66 (N) (INPUT = 1.00)




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T28	1	2	GREEN PARK HOMES	

Famarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:04:10 2020 Page 1

ID:DMCubINVR6Tsf0e31v6l zns11-qYGL6Bq_dL45FP4UNTkGGKpt77_kbX7PuhzMEM2



Scale = 1/4" = 1'-0"

LUMBER	SIZE	DRY	NO.2	DESCR.
CHORDS				
R - A	2x4	DRY	No.2	SPF
A - C	2x6	DRY	No.2	SPF
C - G	2x6	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
I - O	2x6	DRY	No.2	SPF
O - M	2x6	DRY	No.2	SPF
M - J	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
R - A	12	TOP
I - J	12	TOP
A - C	12	TOP
C - G	12	TOP
G - I	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
R - O	12	SIDE(0.0)
O - M	12	SIDE(0.0)
M - J	12	TOP
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REQD
JT	VERT	DOWN	IN-SX	IN-SX
R	3373	0	3-8	3-8
J	3103	0	3-8	3-8

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
R	2380	1591	0	0	0
J	2190	1459	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.03 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX.	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CSI (LC)	MEMB.	FORCE (LBS)
FR-TO				FR-TO	
R-A	-3316	0	0.0	K-I	0
A-B	-4149	0	-91.8	A-Q	0
B-C	-7288	0	-91.8	K-H	-2757
C-D	-7288	0	-91.8	Q-B	-2897
D-S	-8278	0	-91.8	L-H	0
S-T	-8278	0	-91.8	B-P	0
T-U	-8278	0	-91.8	L-F	-1791
U-E	-8278	0	-91.8	P-D	-1403
E-F	-8278	0	-91.8	N-F	0
F-G	-6586	0	-91.8	D-N	0
G-H	-6586	0	-91.8	N-E	-673
H-I	-3787	0	-91.8		
I-J	-3042	0	0.0		
R-Q	0	0	-18.5		
Q-P	0	4149	-18.5		
P-V	0	7288	-18.5		
V-W	0	7288	-18.5		
W-O	0	7288	-18.5		
O-X	0	7288	-18.5		
X-Y	0	7288	-18.5		
Y-N	0	7288	-18.5		
N-Z	0	6586	-18.5		
Z-M	0	6586	-18.5		
M-L	0	6586	-18.5		
L-K	0	3787	-18.5		
K-J	0	0	-18.5		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
S	12-8-4	-86	-86	---	BACK	VERT	TOTAL	C1
T	14-8-4	-86	-86	---	BACK	VERT	TOTAL	C1
U	16-8-4	-86	-86	---	BACK	VERT	TOTAL	C1
V	12-3-8	-1052	-1052	---	BACK	VERT	TOTAL	C1
W	12-8-4	-17	-17	---	BACK	VERT	TOTAL	C1
X	14-8-4	-17	-17	---	BACK	VERT	TOTAL	C1
Y	16-8-4	-17	-17	---	BACK	VERT	TOTAL	C1
Z	18-7-8	-1273	-1273	---	BACK	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CSF: TC=0.58:1.00 (A-R:1), BC=0.72:1.00 (L-N:1),
WB=0.64:1.00 (A-Q:1), SS=0.37:1.00 (L-N:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.69 (INPUT = 0.99)
JSI METAL= 0.73 (INPUT = 1.00)



Structural component only
DWG# T-2007639 1/4

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T28	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:04:10 2020 Page 2


ID:DMCubINVR6TstFoe31v6I_zns11-jqYQL68g CL45FP4UNTkGGKlp1777 kbX7PuhzMEM2

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWW-I	MT20	5.0	8.0	2.50	3.25
B	TMWW-I	MT20	5.0	8.0	2.50	2.75
C	TS-I	MT20	5.0	8.0		
D	TMWW-I	MT20	5.0	8.0		
E	TMWW-w	MT20	3.0	8.0		
F	TMWW-I	MT20	5.0	8.0		
G	TS-I	MT20	5.0	8.0		
H	TMWW-I	MT20	5.0	8.0	2.50	2.75
I	TMWW-I	MT20	5.0	8.0	2.50	3.25
J	BMVI-p	MT20	3.0	8.0		
K	BMWW-I	MT20	5.0	8.0	2.50	3.25
L	BMWW-I	MT20	5.0	8.0	2.50	2.75
M	BS-I	MT20	5.0	8.0		
N	BMWW-I	MT20	5.0	8.0		
O	BS-I	MT20	5.0	8.0		
P	BMWW-I	MT20	5.0	8.0	2.50	2.75
Q	BMWW-I	MT20	5.0	8.0	2.50	3.25
R	BMVI-p	MT20	3.0	8.0		

CONNECTION REQUIREMENTS


1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

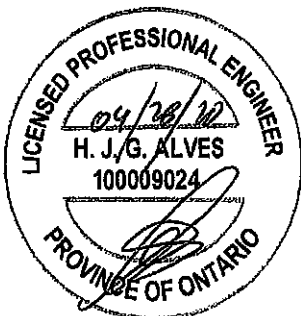

Structural component only
DWG# T-2007639 2/2

JOB NAME 408223	TRUSS NAME T29	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:11 2020 Page 1
 ID:DMCubINVR6TstFoe3iv6l zns1l-As6eYSkmbikCifqbeBuiGUoUPDjibAipBlyR7zMEMMY
 23-2-4 23-2-4 3-9-4 28-11-8 5-10-8 34-10-0
 Scale = 1:54.8

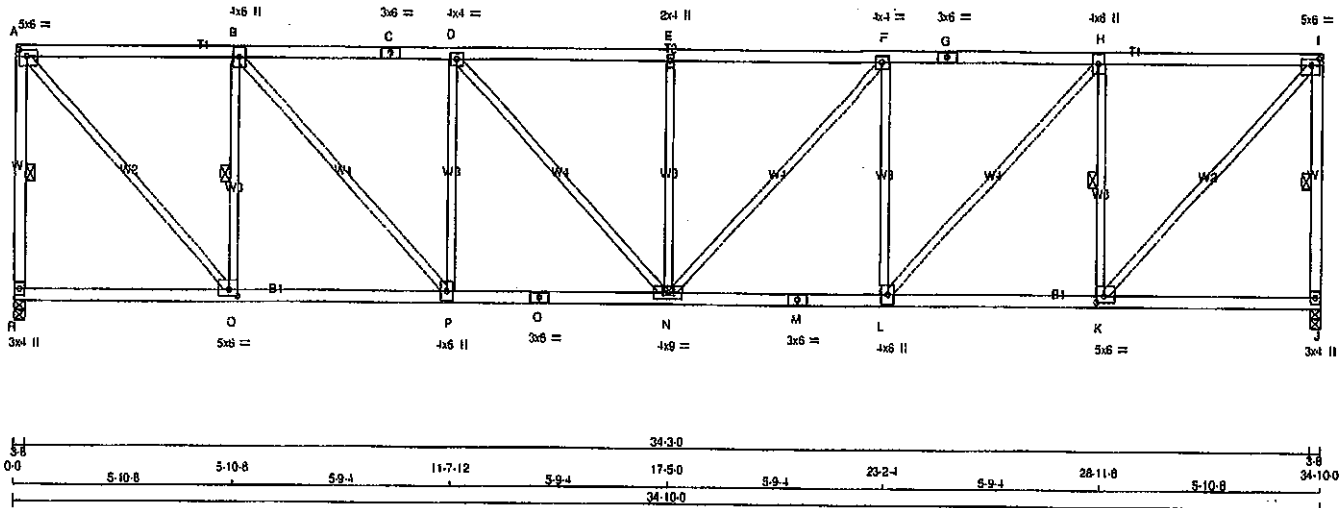

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
R - A	2x4 DRY	No.2	SPF
A - C	2x4 DRY	No.2	SPF
C - G	2x4 DRY	No.2	SPF
G - I	2x4 DRY	No.2	SPF
J - I	2x4 DRY	No.2	SPF
R - O	2x4 DRY	No.2	SPF
O - M	2x4 DRY	No.2	SPF
M - J	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
A	TMVW-1	MT20	5.0	6.0 2.00 2.50
B	TMVW-1	MT20	4.0	6.0
C	TS-1	MT20	3.0	6.0
D	TMVW-1	MT20	4.0	4.0
E	TMVW-1	MT20	2.0	4.0
F	TMVW-1	MT20	4.0	4.0
G	TS-1	MT20	3.0	6.0
H	TMVW-1	MT20	4.0	6.0
I	TMVW-1	MT20	5.0	6.0 2.00 2.50
J	BMVW-1	MT20	3.0	4.0
K	BMVW-1	MT20	5.0	6.0 2.00 2.50
L	BMVW-1	MT20	4.0	6.0
M	BS-1	MT20	3.0	6.0
N	BMVW-1	MT20	4.0	9.0
O	BS-1	MT20	3.0	6.0
P	BMVW-1	MT20	4.0	6.0
Q	BMVW-1	MT20	5.0	6.0 2.00 2.50
R	BMVW-1	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORZ	BRG	IN-SX	BRG	IN-SX
R	1920	0	1920	0	0	3-8	3-8	3-8	3-8
J	1920	0	1920	0	0	3-8	3-8	3-8	3-8

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
R	1358	891	0	0	0	0	0	487	0
J	1358	891	0	0	0	0	0	487	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-R, I-J, B-Q, H-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	FORCE (LBS)	MAX. CS1 (LC)	UNBRACED LENGTH
R-A	-1878	0	0.0	0.0	0.37 (1)	4.80	FR-TO
A-B	-1593	0	-91.8	-91.8	0.53 (1)	4.61	Q-B
B-C	-2428	0	-91.8	-91.8	0.83 (1)	3.77	B-P
C-D	-2428	0	-91.8	-91.8	0.83 (1)	3.77	P-D
D-E	-2725	0	-91.8	-91.8	0.58 (1)	3.72	D-N
E-F	-2725	0	-91.8	-91.8	0.58 (1)	3.72	N-E
F-G	-2428	0	-91.8	-91.8	0.83 (1)	3.77	N-F
G-H	-2428	0	-91.8	-91.8	0.83 (1)	3.77	L-F
H-I	-1583	0	-91.8	-91.8	0.53 (1)	4.61	L-H
I-J	-1878	0	0.0	0.0	0.37 (1)	4.80	K-H
R-Q	0	0	-18.5	-18.5	0.15 (4)	10.00	K-I
Q-P	0	1583	-18.5	-18.5	0.33 (1)	10.00	
P-O	0	2428	-18.5	-18.5	0.44 (1)	10.00	
O-N	0	2428	-18.5	-18.5	0.44 (1)	10.00	
N-M	0	2428	-18.5	-18.5	0.44 (1)	10.00	
M-L	0	2428	-18.5	-18.5	0.44 (1)	10.00	
L-K	0	1583	-18.5	-18.5	0.33 (1)	10.00	
K-J	0	0	-18.5	-18.5	0.15 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPC 2011, TPC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1/16")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.16")
 ALLOWABLE DEFL.(TL) = L/360 (1/16")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.31")

CS1: TC=0.63/1.00 (F-H:1), BC=0.44/1.00 (N-P:1), WB=0.58/1.00 (F-L:1), SS=0.25/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIPDRY SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (A) (INPUT = 0.90)
 JSI METAL = 0.78 (M) (INPUT = 1.00)





Structural component only
 DWG# T-2007640



TOTAL WEIGHT = 2 X 179 = 358 lb

JSI GRIP = 0.87 (H) (INPUT = 0.90)
JSI METAL = 0.46 (K) (INPUT = 1.00)



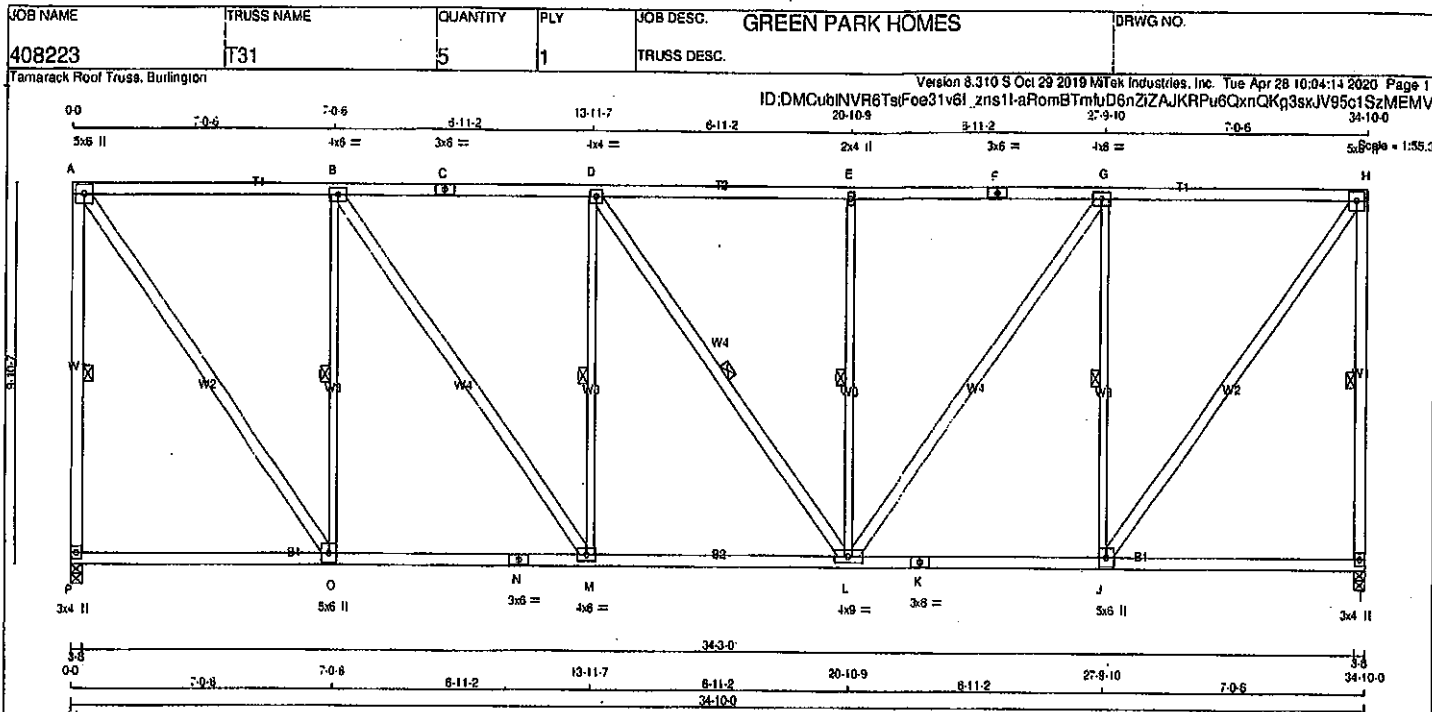

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
P - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
I - H	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2

ALL WEBS 2x4 DRY No.2

EXCEPT

O - B	2x3	DRY	No.2
M - D	2x3	DRY	No.2
L - E	2x3	DRY	No.2
J - G	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A TMWV+p	MT20	5.0	6.0		
B TMWV-1	MT20	4.0	6.0		
C TS-1	MT20	3.0	6.0		
D TMWV-1	MT20	4.0	6.0		
E TMWV-w	MT20	2.0	4.0		
F TS-1	MT20	3.0	6.0		
G TMWV-1	MT20	4.0	6.0		
H TMWV+p	MT20	5.0	6.0		
I BMV1+p	MT20	3.0	4.0		
J BMWV-1	MT20	5.0	6.0		
K BS-1	MT20	3.0	6.0		
L BMWV-1	MT20	4.0	6.0		
M BMWV-1	MT20	4.0	6.0		
N BS-1	MT20	3.0	6.0		
O BMWV-1	MT20	5.0	6.0		
P BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	1920	0	3-8
P VERT	1920	0	3-8
I VERT	1920	0	3-8

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	1358
P COMBINED	891
I COMBINED	891

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.98 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-P, H-I, B-O, D-M, D-L, E-L, G-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	MAX. FACTORED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	MAX. FACTORED LENGTH (FT)
P-A	-1888	0	0.0	0.0	0.88 (1)	A-O	0	1999	0.32 (1)		
A-B	-1183	0	-91.8	-91.8	0.75 (1)	O-B	-1466	0	0.96 (1)		
B-C	-1719	0	-91.8	-91.8	0.82 (1)	B-M	0	918	0.15 (1)		
C-D	-1719	0	-91.8	-91.8	0.82 (1)	M-D	-917	0	0.41 (1)		
D-E	-1718	0	-91.8	-91.8	0.83 (1)	D-L	-2	0	0.00 (1)		
E-F	-1718	0	-91.8	-91.8	0.83 (1)	L-E	-616	0	0.41 (1)		
F-G	-1718	0	-91.8	-91.8	0.83 (1)	G-L	0	913	0.15 (1)		
G-H	-1183	0	-91.8	-91.8	0.75 (1)	H-G	-1465	0	0.96 (1)		
H-I	-1888	0	0.0	0.0	0.88 (1)	I-H	0	2000	0.32 (1)		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CSI TC=0.88/1.00 (H-I), BC=0.38/1.00 (L-M), WB=0.98/1.00 (B-O), SS=0.30/1.00 (G-H)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (H) (INPUT = 0.90)
JSI METAL= 0.43 (H) (INPUT = 1.00)



Structural component only
DWG# T-2007642


JOB NAME 408223	TRUSS NAME T32	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:04:15 2020 Page 1

ID:DMCubINVR6Tsf0e31v6I_zns11-2dL9OpnHIWEeAs8Mt1yeRkZCFqhAoVATkprAauzMEMU

Scale = 1:35.6

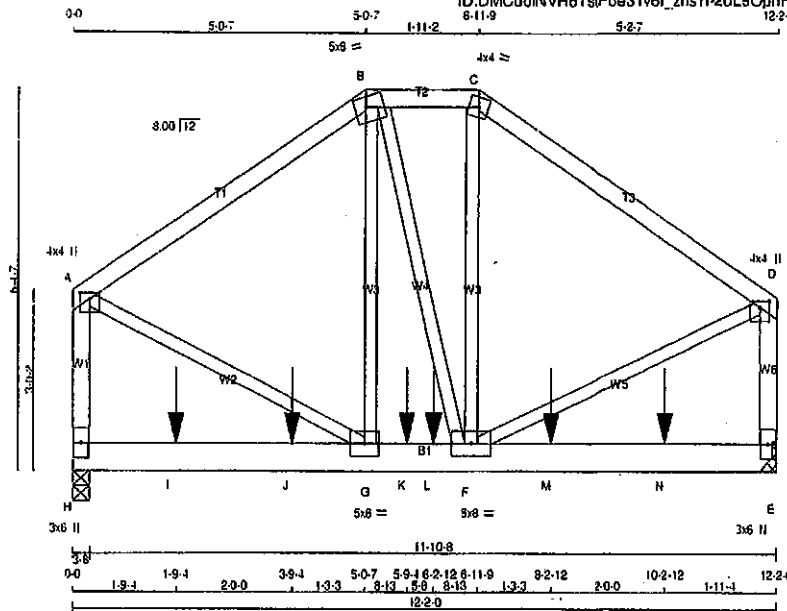

TOTAL WEIGHT = 66 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
H - A	2x4	DRY	No.2
E - D	2x4	DRY	No.2
H - E	2x6	DRY	No.2

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWW+p	MT20	4.0	4.8	1.25	2.00
B	TTWW-m	MT20	5.0	6.0	2.00	2.25
C	TTWW-m	MT20	4.0	4.8		
D	TMWW+p	MT20	4.0	4.8	1.25	2.00
E	BMV1+p	MT20	3.0	6.0		
F	BMWWW-t	MT20	5.0	6.0		
G	BMWW-t	MT20	5.0	6.0		
H	BMV1+p	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	GROSS REACTION	MAXIMUM FACTORED	INPUT	REQD
			GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
H	1233	0	1233	0	3-8
E	1218	0	1218	0	3-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	867	598	0	0	0	271	0
E	858	588	0	0	0	288	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC† MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM	TO		FR-TO		
A-B	-853 0	-91.8	-91.8 0.48 (1)	5.88	G-B	0 122	0.03 (1)
B-C	-721 0	-91.8	-91.8 0.07 (1)	6.25	B-F	0 34	0.01 (1)
C-D	-864 0	-91.8	-91.8 0.51 (1)	5.77	F-C	0 154	0.04 (1)
H-A	-1085 0	0.0	0.0 0.17 (1)	7.60	A-G	0 795	0.20 (1)
E-D	-1057 0	0.0	0.0 0.16 (1)	7.63	F-D	0 794	0.20 (1)
H-I	0 0	-18.5	-18.5 0.20 (1)	10.00			
I-J	0 0	-18.5	-18.5 0.20 (1)	10.00			
J-G	0 0	-18.5	-18.5 0.20 (1)	10.00			
G-K	0 711	-18.5	-18.5 0.28 (1)	10.00			
K-L	0 711	-18.5	-18.5 0.28 (1)	10.00			
L-F	0 711	-18.5	-18.5 0.28 (1)	10.00			
F-M	0 0	-18.5	-18.5 0.20 (1)	10.00			
M-N	0 0	-18.5	-18.5 0.20 (1)	10.00			
N-E	0 0	-18.5	-18.5 0.20 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
I	1-9-4	-172	-172	---	BACK	VERT	TOTAL	---	C1
J	3-8-4	-195	-195	---	BACK	VERT	TOTAL	---	C1
K	5-9-4	-187	-187	---	BACK	VERT	TOTAL	---	C1
L	6-2-12	-187	-187	---	BACK	VERT	TOTAL	---	C1
M	8-2-12	-195	-195	---	BACK	VERT	TOTAL	---	C1
N	10-2-12	-172	-172	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.41")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.41")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.51 1.00 (C-D:1), BC=0.28 1.00 (F-G:1), WB=0.20 1.00 (A-G:1), SS=0.20 1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618	354	1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.78 (D) INPUT = 0.90
JSI METAL= 0.23 (D) INPUT = 1.00




Structural component only
DWG# T-2007643

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T34S	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:04:16 2020 Page 1

ID:DMCubINVR6TetFoe31v6I_zns11-WgvXc9ovOqMVo0IZQKulzXVSIE5FX?yccTaj8KzMEMT

Scale = 1:30.1

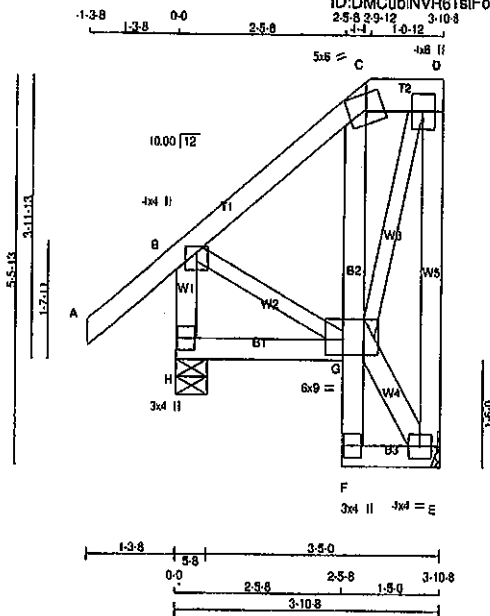

TOTAL WEIGHT = 2 X 32 = 64 lb [M]

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY No.2	SPF
C - D	2x6	DRY No.2	SPF
E - D	2x4	DRY No.2	SPF
H - B	2x4	DRY No.2	SPF
H - G	2x4	DRY No.2	SPF
F - C	2x4	DRY No.2	SPF
F - E	2x4	DRY No.2	SPF
ALL WEBS	2x4	DRY No.2	SPF
EXCEPT			
B - G	2x3	DRY No.2	SPF
G - D	2x3	DRY No.2	SPF
DRY: SEASONED LUMBER.			

PLATES (tab/s in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW+p	MT20	4.0	4.0 1.00 2.00
C	TTV-m	MT20	5.0	6.0
D	TMVW+p	MT20	4.0	6.0
E	BMVW1-i	MT20	4.0	4.0
F	BMV+p	MT20	3.0	4.0
G	BMVWW-i	MT20	6.0	9.0 2.50 3.00
H	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
FACTORED	MAXIMUM FACTORED	INPUT	RECORD		
GROSS REACTION	GROSS REACTION	BRG	BRG		
JT	VERT	HORZ	DOWN	UPLIFT	IN-SX
E	214	0	214	0	0
H	341	0	341	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS						
1ST LCASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
E	151	99.0	0.0	0.0	0.0	52.0
H	239	170.0	0.0	0.0	0.0	69.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED		MEMB.	MAX. FACTORED		
	FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. CS1 (LC)		FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0.41	-91.8	-91.8 0.14 (5)	10.00	G-E	6.0	0.00 (1)
B-C	-62.0	-91.8	-91.8 0.12 (1)	8.25	B-G	0.53	0.01 (1)
C-D	51.0	-91.8	-91.8 0.01 (1)	8.25	G-D	0.154	0.03 (1)
E-D	-197.0	0.0	0.0 0.10 (1)	7.81			
H-B	-317.0	0.0	0.0 0.03 (1)	7.81			
H-G	0.0	-18.5	-18.5 0.04 (4)	10.00			
F-G	0.13	0.0	0.0 0.01 (1)	10.00			
G-C	-138.0	0.0	0.0 0.01 (1)	7.81			
F-E	0.4	-18.5	-18.5 0.01 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 240 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CS1: TC=0.14/1.00 (A-B-5), BC=0.04/1.00 (G-H-4), WB=0.03/1.00 (D-G-1), SS1=0.09/1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (B) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007644


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T35S	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:17 2020 Page 1

ID:DMCubINVR6TslFos31v6l_zns1l-.0TvpVoXB8UMQAHl_S?6W2dVdRQGSEmC7KGenzMEMS

Scale = 1/20

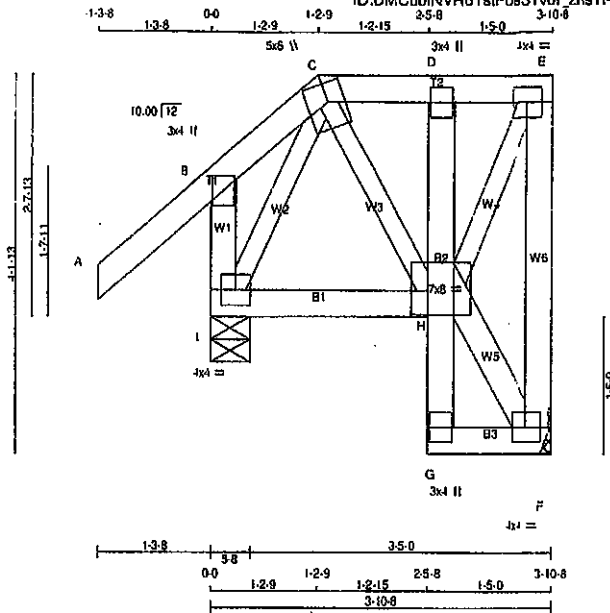

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER	DESCR	
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
I - B	2x4	DRY	No.2	SPF	
I - H	2x4	DRY	No.2	SPF	
G - D	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT		2x3	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF	
DRY; SEASONED LUMBER.					

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TTWW+m	MT20	5.0	6.0	2.50	2.25
D	TMV+p	MT20	3.0	4.0		
E	TMV+p	MT20	4.0	4.0		
F	BMVW-1	MT20	4.0	4.0		
G	BMV+p	MT20	3.0	4.0		
H	BMVWW-1	MT20	7.0	8.0	3.25	2.25
I	BMVW-1	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
F	191	0	191	0
I	383	0	383	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW
F	135	86
I	254	183

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LG1 MAX CSI (LC)	MAX. UNBRAC LENGTH	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO					FR-TO		
A-B	0 41	-91.8	-91.8 0.14 (5)	10.00	H-F	-6 0	0.00 (1)
B-C	-45 0	-91.8	-91.8 0.14 (5)	6.25	H-E	0 141	0.03 (1)
C-D	-69 0	-91.8	-91.8 0.02 (1)	6.25	C-H	0 48	0.01 (1)
D-E	-87 0	-91.8	-91.8 0.02 (1)	6.25	I-C	-96 28	0.02 (1)
F-E	-175 0	0.0	0.0 0.05 (1)	7.81			
I-B	-255 0	0.0	0.0 0.03 (1)	7.81			
I-H	-13 45	-18.5	-18.5 0.04 (4)	6.25			
G-H	0 13	0.0	0.0 0.01 (1)	10.00			
H-D	-135 0	0.0	0.0 0.01 (1)	7.81			
G-F	0 4	-18.5	-18.5 0.01 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 2 X 29 = 57 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN (LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/989 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/989 (0.00")

CSI: TC=0.14/1.00 (A-B-5), BC=0.04/1.00 (H-I-4), WB=0.03/1.00 (E-H-1), SI=0.08/1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.18 (E) INPUT = 0.80
JSI METAL= 0.09 (B) INPUT = 1.00



Structural component only
DWG# T-2007645

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T36	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:18 2020 Page 1
 ID:DMCubINVR6TslFoe31v6l zns1l-TC1H0rp9yRcD1KsxY9WL2ybo51j2?vnVnQn3qBDzMEMR
 Scale = 1:10.9

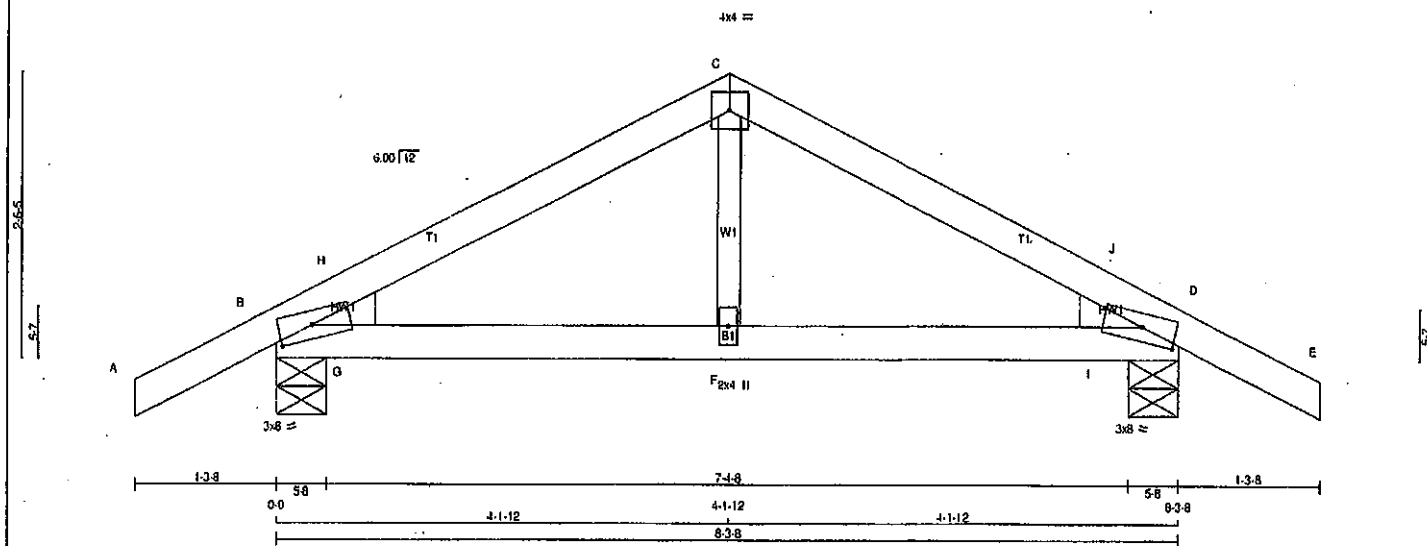

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2		SPF	
C - E	2x4	DRY	No.2		SPF	
B - D	2x4	DRY	No.2		SPF	

ALL WEBS 2x3 DRY No.2
 DRY: SEASONED LUMBER.

PLATES (table in inches)	W	LEN	Y	X
B TMBH1-m	MT20	3.0	8.0	1.50 3.75
C TTW-p	MT20	4.0	4.0	
D TMBH1-m	MT20	3.0	8.0	1.50 3.75
F BMW-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG	HEEL
JT VERT	HORZ	DOWN	HORZ	UPLIFT
B	582 0	582 0	5-8	5-8
D	582 0	582 0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	409	282 0	0 0	0 0	0 0	127 0	0 0	0 0
D	409	282 0	0 0	0 0	0 0	127 0	0 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MEMB.	FORCE	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED
FR-TO	FORCE	(PLF)	CS1 (LC)	UNBRAC	LENGTH	FR-TO	FORCE	MAX	CS1 (LC)	
A-B	0 23	-91.8	-91.8	0.12 (1)	10.00	F-C	0 170	0.04 (1)		
B-H	-539 0	-91.8	-91.8	0.04 (1)	8.25	G-H	-158 3	0.00 (1)		
H-C	-525 0	-91.8	-91.8	0.15 (1)	8.25	I-J	-158 3	0.00 (1)		
C-J	-525 0	-91.8	-91.8	0.15 (1)	8.25					
J-D	-539 0	-91.8	-91.8	0.04 (1)	6.25					
D-E	0 23	-91.8	-91.8	0.12 (1)	10.00					
B-G	0 465	-18.5	-18.5	0.21 (1)	10.00					
G-F	0 465	-18.5	-18.5	0.21 (1)	10.00					
F-I	0 465	-18.5	-18.5	0.21 (1)	10.00					
I-O	0 465	-18.5	-18.5	0.21 (1)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPC 2011, TPC 2014

55% OF 31.3 P.S.F. O.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.28")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
 ALLOWABLE DEFL.(TL) = L/360 (0.28")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CS1: TC=0.15/1.00 (C-J:1), BC=0.21/1.00 (F-I:1)
 WB=0.04/1.00 (C-F:1), SS=0.12/1.00 (C-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1687 788	1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.25 (8) (INPUT = 0.90)
 JSI METAL = 0.11 (8) (INPUT = 1.00)

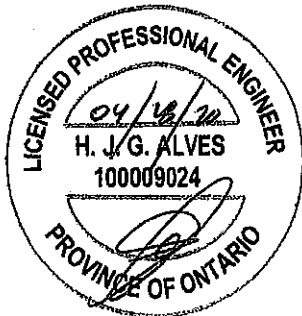


Structural component only
 DWG# T-2007646

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	G36	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:03:49 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-pdnKxwTznXyK3l8MLaVXNnrubL5ioKemmYnIPzMEMu

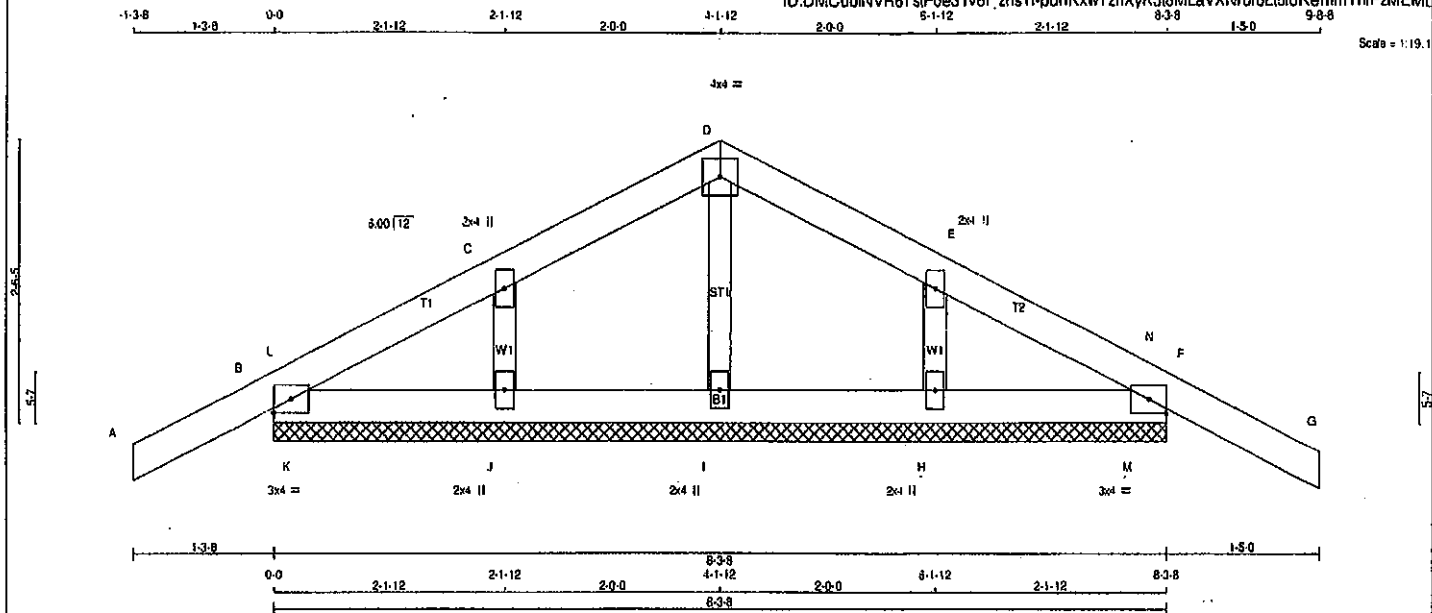

LUMBER				
N. L. G. A. RULES				
CHORDS :	SIZE	LUMBER	DESCR	
A - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
B - F	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
ALL GABLE WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y
B	TM1-I	MT20	3.0	4.0	Edge
C	TMW+W	MT20	2.0	4.0	
D	TTW-P	MT20	4.0	4.0	
E	TMW+W	MT20	2.0	4.0	
F	TM1-I	MT20	3.0	4.0	Edge
H, I, J	BMW1+W	MT20	2.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM TO		FR-TO			
A-B	0 23	-91.8 -91.8 0.12 (1)	10.00	I-D	-115 0	0.02 (1)	
B-L	-61 0	-91.8 -91.8 0.01 (4)	6.25	J-C	-218 0	0.03 (1)	
L-C	-39 0	-91.8 -91.8 0.08 (1)	6.25	H-E	-218 0	0.03 (1)	
C-D	-45 0	-91.8 -91.8 0.08 (1)	6.25	K-L	-52 7	0.00 (1)	
D-E	-45 0	-91.8 -91.8 0.08 (1)	6.25	M-N	-52 7	0.00 (1)	
E-N	-39 0	-91.8 -91.8 0.06 (1)	6.25				
N-F	-61 0	-91.8 -91.8 0.01 (4)	6.25				
F-G	0 25	-91.8 -91.8 0.14 (1)	10.00				
B-K	0 44	-18.5 -18.5 0.03 (1)	10.00				
K-J	0 44	-18.5 -18.5 0.03 (1)	10.00				
J-I	0 32	-18.5 -18.5 0.02 (1)	10.00				
I-H	0 32	-18.5 -18.5 0.02 (1)	10.00				
H-M	0 44	-18.5 -18.5 0.03 (1)	10.00				
M-F	0 44	-18.5 -18.5 0.03 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
	CL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	CL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

15% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.14/1.00 (F-G:1), BC=0.03/1.00 (H-M:1), WB=0.03/1.00 (E-H:1), SS=0.10/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	818	354	1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.21 (B) (INPUT = 0.90)
JSI METAL=0.09 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007821

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T37	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MT&K Industries, Inc. Tue Apr 28 10:04:19 2020 Page 1
ID:DMCubINVR6TsIFoa31v6i_zns11-xPbIEBgnjk4UR76t1abA7yUR47k12RPNjzMEMQ

Scale = 1:17.0

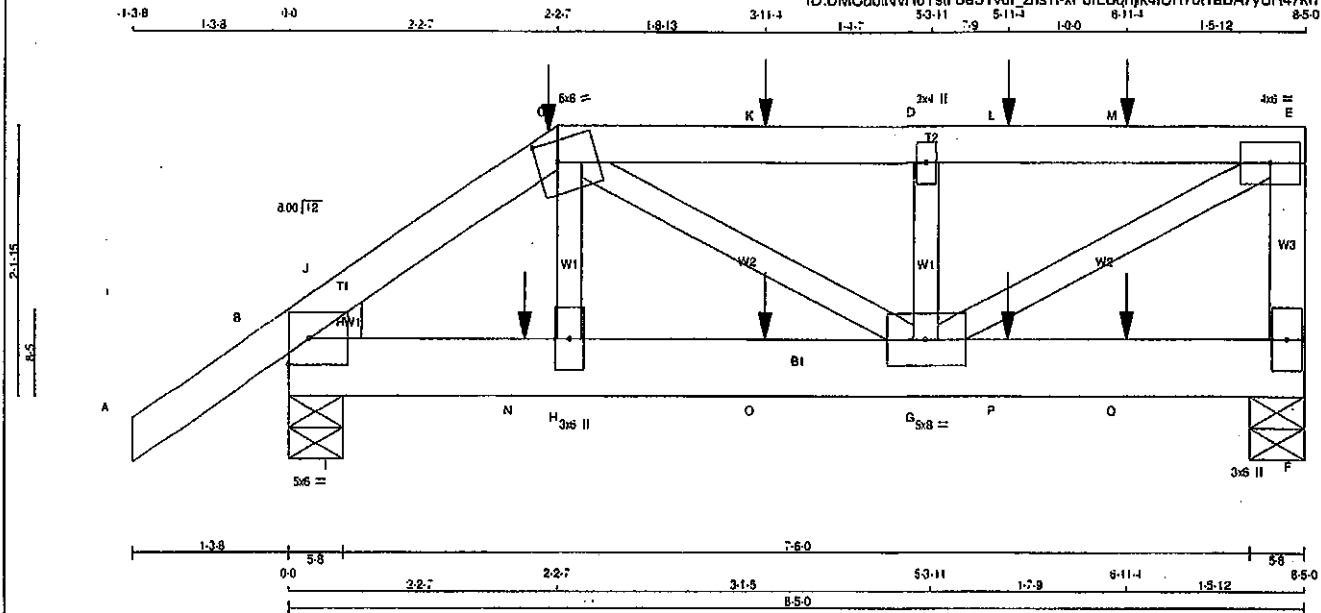

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
F - E	2x4	DRY	No.2
B - F	2x6	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

PLATES (Tables in inches)					
JT	TYPE	PLATES	W	LEN	X
B	TMGH-1	MT20	5.0	8.0	Edge
C	TMVW-m	MT20	5.0	6.0	2.00
D	TMVW-w	MT20	2.0	4.0	
E	TMVW-l	MT20	4.0	6.0	
F	BMV1-p	MT20	3.0	8.0	
G	BMVWW-l	MT20	5.0	8.0	
H	BMVW-w	MT20	3.0	6.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD		HEEL	
JT	VERT	GROSS REACTION	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	WEDGE		
F	597	0	760	0	0	5-8	5-8	5-8			
B	823	0	823	0	0	5-8	5-8	5-8			2x4 L

UNFACTORED REACTIONS		1ST LCASE		MAX. MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL				
F	597	352.0	0.0	0.0	0.0	165.0	0.0				
B	590	392.0	0.0	0.0	0.0	168.0	0.0				

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS F, B

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING				TOTAL LOAD CASES: (4)			
CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. CSI (LC1)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC1)	
FR-TO		FROM TO	UNBRAC LENGTH	FR-TO			
A-B	0 26	-91.8 -91.8 0.13 (1)	10.00	H-C	0 73	0.02 (4)	
B-J	-1068 0	-91.8 -91.8 0.08 (1)	5.99	C-G	0 252	0.06 (1)	
J-C	-860 0	-91.8 -91.8 0.08 (1)	6.25	G-D	-528 0	0.09 (1)	
C-K	-923 0	-91.8 -91.8 0.24 (1)	6.09	G-E	0 1062	0.26 (1)	
K-D	-923 0	-91.8 -91.8 0.24 (1)	6.09	I-J	0 207	0.00 (1)	
D-L	-924 0	-91.8 -91.8 0.24 (1)	6.09				
L-M	-924 0	-91.8 -91.8 0.24 (1)	6.09				
M-E	-924 0	-91.8 -91.8 0.24 (1)	6.09				
F-E	-882 0	0.0 0.0 0.08 (1)	7.81				
B-I	0 701	-18.5 -18.5 0.14 (1)	10.00				
I-N	0 701	-18.5 -18.5 0.14 (1)	10.00				
N-H	0 701	-18.5 -18.5 0.14 (1)	10.00				
H-O	0 705	-18.5 -18.5 0.15 (1)	10.00				
O-G	0 705	-18.5 -18.5 0.15 (1)	10.00				
G-P	0 0	-18.5 -18.5 0.07 (1)	10.00				
P-O	0 0	-18.5 -18.5 0.07 (1)	10.00				
O-F	0 0	-18.5 -18.5 0.07 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL
C	2-2-7	-88	-88	FRONT	VERT	TOTAL	C1
K	3-11-4	-83	-83	FRONT	VERT	TOTAL	C1
L	5-11-4	-83	-83	FRONT	VERT	TOTAL	C1
M	8-11-4	-83	-83	FRONT	VERT	TOTAL	C1
N	1-11-4	-48	-48	FRONT	VERT	TOTAL	C1
O	3-11-4	-48	-48	FRONT	VERT	TOTAL	C1
P	5-11-4	-48	-48	FRONT	VERT	TOTAL	C1
Q	6-11-4	-48	-48	FRONT	VERT	TOTAL	C1

CONNECTION REQUIREMENTS
1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G.C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.28")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.28")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.24/1.00 (D-E:1), BC=0.15/1.00 (G-H:1), WB=0.26/1.00 (E-G:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	618	354	1687 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.61 (E) (INPUT = 0.90)
JSI METAL= 0.24 (E) (INPUT = 1.00)

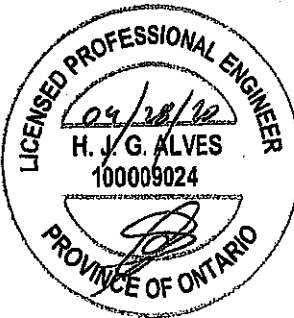

Structural component only
DWG# T-2007647

Tamarack Roof Truss, Burlington

Version 6.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:03:50 2020 Page 1

ID:DMCubInVRS6TsfFoe3t1v6l zns1l-HqL8GTyR4BgQjZvH0mw2R1adRRRBmn_QHLBrzMEM

-1-3-8 0-0 1-10-8 7-10-8 5-10-8 7-10-8 9-10-8
1-3-8 1-10-8 2-0-0 2-0-0 2-0-0 2-0-0 7-9-0
17-7-6 27-6-0 29-8-8
3-10-8 1-3-8-2



TOTAL WEIGHT = 2 X 152 = 303 lb

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

GABLE STUDS SPACED AT 2'-0" OC.

LOADING										
TOTAL LOAD CASES: (4)										
CHORDS					WEBS					
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED	MAX	
FR-TO		FROM TO				FR-TO			CSI (LC)	
AG-B	-292 0	0.0	0.0	0.03 (1)	7.81	W-K	-140 0		0.09 (1)	
A-B	0 41	-91.8	-91.8	0.13 (1)	10.00	Y-J	-210 0		0.14 (1)	
B-C	-80 0	-91.8	-91.8	0.12 (1)	6.25	Z-I	-181 0		0.12 (1)	
C-D	-23 0	-91.8	-91.8	0.05 (1)	6.25	AA-H	-182 0		0.12 (1)	
D-E	-26 0	-91.8	-91.8	0.05 (1)	6.25	V-L	-203 0		0.27 (1)	
E-F	-19 0	-91.8	-91.8	0.05 (1)	6.25	U-M	-175 0		0.13 (1)	
F-G	-29 0	-91.8	-91.8	0.05 (1)	6.25	T-N	-192 0		0.07 (1)	
G-H	-12 0	-91.8	-91.8	0.04 (1)	6.25	S-C	-126 0		0.03 (1)	
H-I	-12 0	-91.8	-91.8	0.04 (1)	6.25	AB-G	-121 0		0.08 (1)	
I-J	-12 0	-91.8	-91.8	0.05 (1)	6.25	AC-F	-202 0		0.27 (1)	
J-K	-12 0	-91.8	-91.8	0.05 (1)	6.25	AD-E	-176 0		0.13 (1)	
K-L	-30 0	-91.8	-91.8	0.05 (1)	6.25	AE-D	-192 0		0.07 (1)	
L-M	-19 0	-91.8	-91.8	0.05 (1)	6.25	AF-C	-126 0		0.02 (1)	
M-N	-26 0	-91.8	-91.8	0.05 (1)	6.25	BA-F	0 32		0.01 (1)	
N-O	-24 0	-91.8	-91.8	0.05 (1)	6.25	S-P	0 32		0.01 (1)	
O-P	-60 0	-91.8	-91.8	0.12 (1)	6.25					
P-Q	0 41	-91.8	-91.8	0.13 (1)	10.00					
R-P	-293 0	0.0	0.0	0.03 (1)	7.81					
AG-AF	0 0	-18.5	-18.5	0.02 (4)	10.00					
AF-AE	0 23	-18.5	-18.5	0.02 (4)	10.00					
AE-AD	0 19	-18.5	-18.5	0.02 (4)	10.00					
AD-AC	0 16	-18.5	-18.5	0.02 (4)	10.00					
AC-AB	0 14	-18.5	-18.5	0.02 (4)	10.00					
AB-AA	0 12	-18.5	-18.5	0.01 (4)	10.00					
AA-Z	0 12	-18.5	-18.5	0.02 (4)	10.00					
Z-Y	0 12	-18.5	-18.5	0.02 (4)	10.00					
Y-X	0 12	-18.5	-18.5	0.02 (4)	10.00					
X-W	0 12	-18.5	-18.5	0.02 (4)	10.00					
W-V	0 14	-18.5	-18.5	0.02 (4)	10.00					
V-U	0 16	-18.5	-18.5	0.02 (4)	10.00					
U-T	0 19	-18.5	-18.5	0.02 (4)	10.00					
T-S	0 23	-18.5	-18.5	0.02 (4)	10.00					
S-R	0 0	-18.5	-18.5	0.02 (4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	OL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	OL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018 , CBC 2012 , ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF

155 K OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSK: TC=0.13/1.00 (P-Q); BC=0.02/1.00 (S-T); W=0.27 1.00 (L-V); SS=0.09/1.00 (J-K);

DOL LUMBER=1.00 NAIL=1.00 (S BEND)=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20 018 354	1687 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.62 (K) (INPUT = 0.90)
JSI METAL= 0.11 (L) (INPUT = 1.00)



Structural component only
DWG# T-2007622


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408224	T40	1	2	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Tue Apr 28 10:19:57 2020 Page 1

ID:DMCubINVR6TstFoe31v6J_zns1I-TsGG5wA9pyw_Bd8P2IsKcz_APYAIVTa7LN10dlzME7m

1-3-8 0-0 5-10-8 5-10-8 5-10-14 11-9-8 5-9-10 17-7-0 19-2-12 4-1-14 23-4-10 5-10-14 29-3-8 35-2-0 38-5-8 1-3-8
Scale = 1:57.6

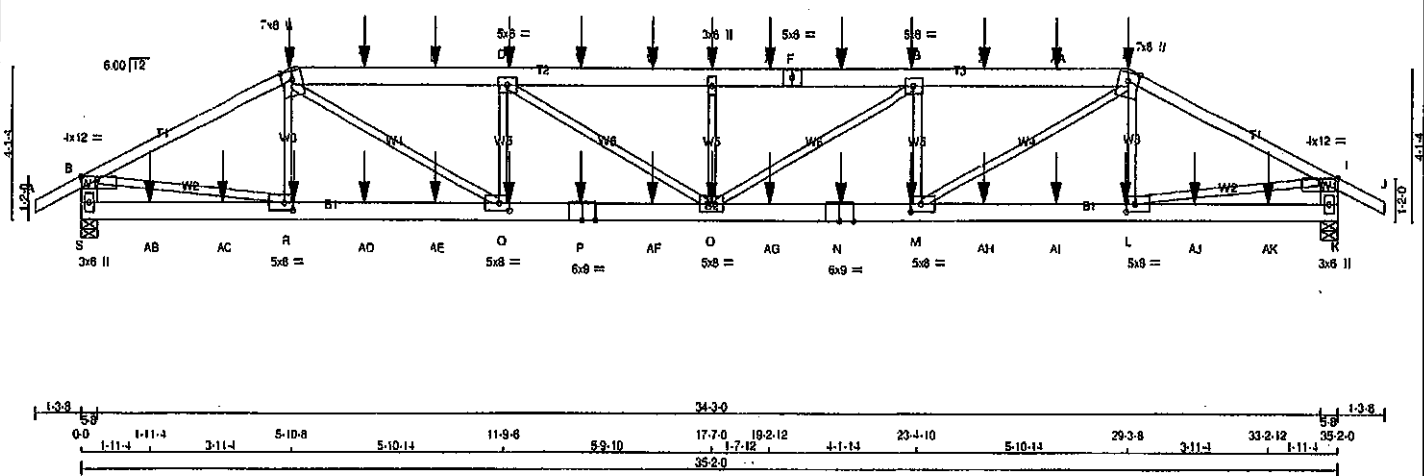

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - F	2x6	DRY	No.2	SPF	
F - H	2x6	DRY	No.2	SPF	
H - J	2x4	DRY	No.2	SPF	
S - B	2x6	DRY	No.2	SPF	
K - I	2x6	DRY	No.2	SPF	
S - P	2x8	DRY	1650F 1.5E	SPF	
P - N	2x6	DRY	1650F 1.5E	SPF	
N - K	2x6	DRY	1650F 1.5E	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS SURFACE SPACING (IN) LOAD (PLF)

TOP CHORDS: 10.122"x3" SPIRAL NAILS

A-C 1 12 SIDE(61.0)

H-J 1 12 SIDE(61.0)

C-F 2 12 SIDE(183.1)

F-H 2 12 SIDE(183.1)

S-B 2 12 TOP

K-I 2 12 TOP

BOTTOM CHORDS: 10.122"x3" SPIRAL NAILS

S-P 2 12 SIDE(183.1)

P-N 2 12 SIDE(183.1)

N-K 2 12 SIDE(183.1)

WEBS: 10.122"x3" SPIRAL NAILS

2x3 1 6

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
BEARINGS							
	FACTORED	GROSS REACTION	MAXIMUM FACTORED	INPUT	REQD		
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
JT	3323	0	3323	0	5-8	5-8	
S	3323	0	3323	0	5-8	5-8	
K	3323	0	3323	0	5-8	5-8	

UNFACTORED REACTIONS							
	1ST LCASE	MAX. MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	2350	1539	0	0	0	811	0
S	2350	1539	0	0	0	811	0
K	2350	1539	0	0	0	811	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.87 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING				TOTAL LOAD CASES: 14)			
CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORIZ. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORIZ. LOAD (LBS)
FR-TO				FR-TO			
A-B	0 28	-91.8	-91.8 0.07 (1)	10.00	R-C	-413 20	0.05 (1)
B-C	-5066 0	-91.8	-91.8 0.52 (1)	3.87	C-Q	0 3193	0.40 (1)
C-T	-7264 0	-91.8	-91.8 0.27 (1)	4.26	Q-D	-1500 0	0.18 (1)
T-U	-7264 0	-91.8	-91.8 0.27 (1)	4.26	D-O	0 946	0.12 (1)
U-D	-7264 0	-91.8	-91.8 0.27 (1)	4.26	O-E	-830 0	0.10 (1)
D-V	-8084 0	-91.8	-91.8 0.27 (1)	4.08	E-G	0 946	0.12 (1)
V-W	-8084 0	-91.8	-91.8 0.27 (1)	4.08	M-G	-1500 0	0.18 (1)
W-E	-8084 0	-91.8	-91.8 0.27 (1)	4.08	M-H	0 3193	0.40 (1)
E-X	-8084 0	-91.8	-91.8 0.27 (1)	4.08	L-H	-413 20	0.05 (1)
X-F	-8084 0	-91.8	-91.8 0.27 (1)	4.08	B-R	0 4582	0.57 (1)
F-Y	-8084 0	-91.8	-91.8 0.27 (1)	4.08	L-I	0 4582	0.57 (1)
Y-G	-8084 0	-91.8	-91.8 0.27 (1)	4.08			
G-Z	-7264 0	-91.8	-91.8 0.27 (1)	4.26			
Z-AA	-7264 0	-91.8	-91.8 0.27 (1)	4.26			
AA-H	-7264 0	-91.8	-91.8 0.27 (1)	4.26			
H-I	-5085 0	-91.8	-91.8 0.52 (1)	3.87			
I-J	0 28	-91.8	-91.8 0.07 (1)	10.00			
S-B	-3248 0	0.0	0.0 0.11 (1)	7.69			
K-I	-3248 0	0.0	0.0 0.11 (1)	7.69			

FACTORED CONCENTRATED LOADS (LBS)			
JT	LOC.	LC1	MAX.
C	5-10-8	-429	-429
D	11-11-4	-110	-110

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2015, CBC 2012, ABC 2019

- PART 9 OF CBC 2012 (2019 AMENDMENT)

- CSA 086-08, CSA 086-14

- TPC 2011, TPC 2014

15% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')

CALCULATED VERT. DEFL.(LL) = L/899 (0.21')

ALLOWABLE DEFL.(TL) = L/360 (1.17')

CALCULATED VERT. DEFL.(TL) = L/989 (0.39')

CSI: TC=0.52(1.00)(B-C:1), BC=0.34(1.00)(O-Q:1), WB=0.57(1.00)(B-R:1), SS=0.15(1.00)(G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 818 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.58 (R) (INPUT = 0.90)

JSI METAL= 0.56 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007660 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T40	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:19:57 2020 Page 2

ID:DMCubINVR6TsIFoe31v6I zns1I-TsGG5wA9pyw Bd8P2lsXcz APYAVTa7LN10dizME7m

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	4.0	12.0	1.00	5.50
C	TTWW+m	MT20	7.0	8.0	Edge	
D	TMWV-l	MT20	5.0	6.0		
E	TMW-w	MT20	3.0	6.0		
F	TS-l	MT20	5.0	6.0		
G	TMWV-l	MT20	5.0	6.0		
H	TTWW+m	MT20	7.0	8.0	Edge	
I	TMWV-p	MT20	4.0	12.0	1.00	5.50
K	BMV1+p	MT20	3.0	6.0		
L	BMWV-l	MT20	5.0	8.0	2.50	3.00
M	BMWV-l	MT20	5.0	8.0	2.50	3.25
N	BS-l	MT20	6.0	9.0		
O	BMWV-l	MT20	5.0	8.0		
P	BS-l	MT20	6.0	9.0		
Q	BMWV-l	MT20	5.0	8.0	2.50	3.25
R	BMWV-l	MT20	5.0	8.0	2.50	3.00
S	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	17-7-0	-110	-110	---	FRONT	VERT	TOTAL	---	C1
G	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	29-3-8	-429	-429	---	FRONT	VERT	TOTAL	---	C1
L	29-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
M	23-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
N	21-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
O	17-7-0	-26	-26	---	FRONT	VERT	TOTAL	---	C1
P	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Q	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	19-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	21-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	1-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AC	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AD	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AE	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AF	15-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	19-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	25-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	27-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	31-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	33-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007660

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	T40Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:19:58 2020 Page 2

ID:DMCubINVR6TstFoe3iv6l_zns1l-x2qeJGBoaF2pnibcaNm9BWHeyQ8EpcGa1mZAkzME7l

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	12.0	1.00	5.50
C	TTWW+m	MT20	7.0	8.0	Edge	
D	TMWW-l	MT20	5.0	6.0		
E	TMW+w	MT20	3.0	6.0		
F	TS-l	MT20	5.0	6.0		
G	TMWW-l	MT20	5.0	6.0		
H	TTWW+m	MT20	7.0	8.0	Edge	
I	TMVW-p	MT20	4.0	12.0	1.00	5.50
K	BMV1+p	MT20	3.0	6.0		
L	BMWW-l	MT20	5.0	8.0	2.50	3.00
M	BMWW-l	MT20	5.0	8.0	2.50	3.25
N	BS-l	MT20	6.0	9.0		
O	BMWW-l	MT20	5.0	8.0		
P	BS-l	MT20	6.0	9.0		
Q	BMWW-l	MT20	5.0	8.0	2.50	3.25
R	BMWW-l	MT20	5.0	8.0	2.50	3.00
S	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
Q	11-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
T	13-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
U	15-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	18-8-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
W	20-8-4	-159	-159	---	BACK	VERT	TOTAL	---	C1
X	22-8-4	-159	-159	---	BACK	VERT	TOTAL	---	C1
Y	10-7-8	-1171	-1171	---	BACK	VERT	TOTAL	---	C1
Z	15-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AA	18-8-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AB	20-8-4	-32	-32	---	BACK	VERT	TOTAL	---	C1
AC	22-8-4	-32	-32	---	BACK	VERT	TOTAL	---	C1
AD	24-7-8	-2237	-2237	---	BACK	VERT	TOTAL	---	C1
AE	26-8-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AF	28-8-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AG	30-8-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AH	32-8-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AI	33-5-4	-121	-121	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

11 C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2007661 *7/2*

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	T41	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 20 2019 Mittek Industries, Inc. Tue Apr 28 10:19:59 2020 Page 1
ID:DMCubINVR6TstFos31v6l zns1t-PFO0WcCOLZAIQxtoAHu?hO3QDMnRzI?PphW7IAzME7k

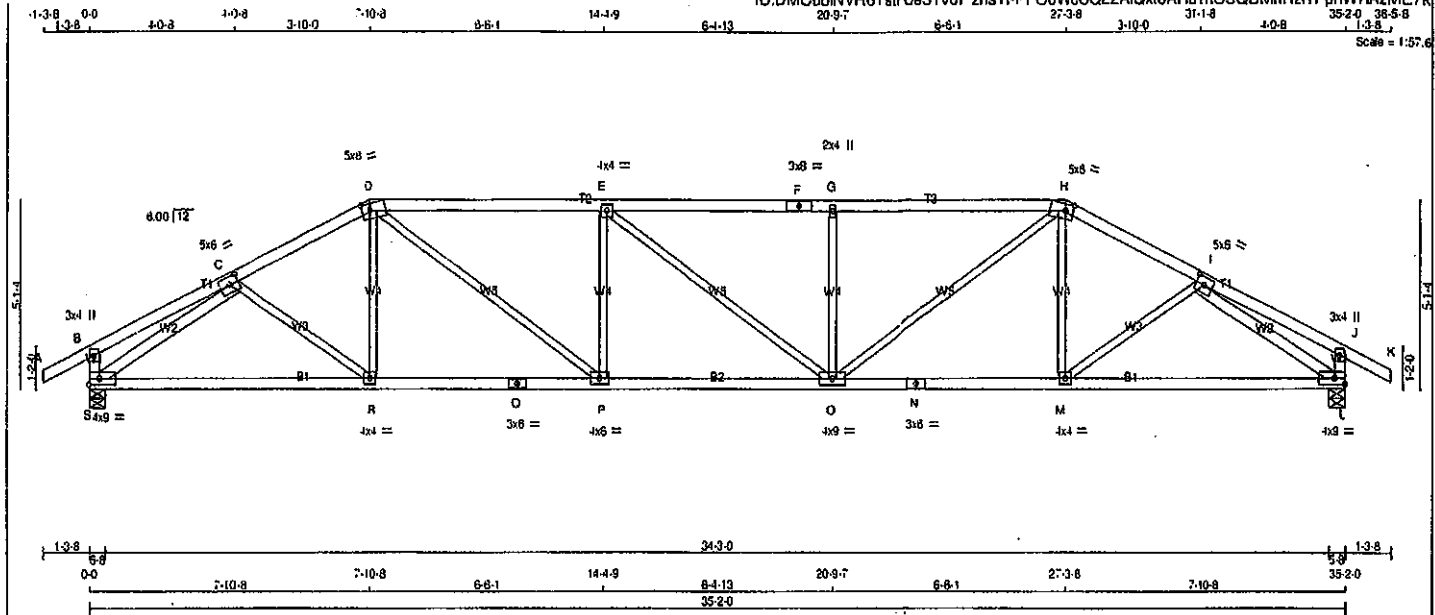

TOTAL WEIGHT = 2 X 139 = 278 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
O - F	2x4	DRY	No.2	SPF		
F - H	2x4	DRY	No.2	SPF		
H - K	2x4	DRY	No.2	SPF		
S - B	2x4	DRY	No.2	SPF		
L - J	2x4	DRY	No.2	SPF		
S - Q	2x4	DRY	No.2	SPF		
O - N	2x4	DRY	No.2	SPF		
N - L	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						
S - C	2x4	DRY	No.2	SPF		
I - L	2x4	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-m	MT20	5.0	6.0	2.50	2.75
D	TTWW-m	MT20	5.0	6.0	2.25	2.75
E	TMWW-l	MT20	4.0	4.0		
F	TS-l	MT20	3.0	8.0		
G	TMW-w	MT20	2.0	4.0		
H	TTWW-m	MT20	5.0	6.0	2.25	2.75
I	TMWW-l	MT20	5.0	6.0	2.50	2.75
J	TMV+p	MT20	3.0	4.0		
L	BMWW-l	MT20	4.0	9.0		Edge
M	BMWW-l	MT20	4.0	4.0		
N	BS-l	MT20	3.0	6.0		
O	BMWW-l	MT20	4.0	9.0		
P	BMWW-l	MT20	4.0	6.0		
Q	BS-l	MT20	3.0	6.0		
R	BMWW-l	MT20	4.0	4.0		
S	BMWW-l	MT20	4.0	9.0		Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	RECORD
S	2063	0	2063	0	0	5-8	5-8	
L	2063	0	2063	0	0	5-8	5-8	

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1457	989	0	0	0	0	0
L	1457	989	0	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.94 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 28	-91.8 -91.8 0.12 (1)	10.00	C-R	0 93	0.03 (4)	
B-C	0 16	-91.8 -91.8 0.20 (1)	10.00	R-D	0 121	0.04 (4)	
C-D	-2799 0	-91.8 -91.8 0.32 (1)	3.88	D-P	0 1267	0.29 (1)	
D-E	-3508 0	-91.8 -91.8 0.95 (1)	2.94	P-E	-843 0	0.25 (1)	
E-F	-3507 0	-91.8 -91.8 0.93 (1)	2.94	E-O	-2 0	0.00 (1)	
F-G	-3507 0	-91.8 -91.8 0.93 (1)	2.94	O-G	-843 0	0.25 (1)	
G-H	-3507 0	-91.8 -91.8 0.94 (1)	2.95	O-H	0 1266	0.20 (1)	
H-I	-2799 0	-91.8 -91.8 0.32 (1)	3.88	M-H	0 121	0.04 (4)	
I-J	0 16	-91.8 -91.8 0.20 (1)	10.00	M-I	0 93	0.03 (4)	
J-K	0 28	-91.8 -91.8 0.12 (1)	10.00	S-C	-2974 0	0.83 (1)	
S-B	-270 0	0.0 0.0 0.03 (1)	7.81	I-L	-2974 0	0.83 (1)	
L-J	-270 0	0.0 0.0 0.03 (1)	7.81				
S-R	0 2417	-18.5 -18.5 0.53 (1)	10.00				
R-Q	0 2489	-18.5 -18.5 0.54 (1)	10.00				
Q-P	0 2489	-18.5 -18.5 0.54 (1)	10.00				
P-O	0 3509	-18.5 -18.5 0.64 (1)	10.00				
O-N	0 2489	-18.5 -18.5 0.54 (1)	10.00				
N-M	0 2489	-18.5 -18.5 0.54 (1)	10.00				
M-L	0 2417	-18.5 -18.5 0.53 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL	= 6.0	PSF
BOT CH.	LL = 0.0	PSF
DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00-12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.21')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.41')

CS: TC=0.95/1.00 (D-E:1), BC=0.84/1.00 (O-P:1), WB=0.83/1.00 (I-L:1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE REELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX	MIN	MAX
MIN	MAX	MIN
MT20	618	354
	1887	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (I, L) (INPUT = 0.90)
JSI METAL = 0.77 (N) (INPUT = 1.00)




Structural component only
DWG# T-2007662

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	T42	2	1	TRUSS DESC.		

Tamareck Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTak Industries, Inc. Tue Apr 28 10:20:01 2020 Page 1
ID:DMCubINVR6TsiFoe31v8l_zns1H-LdWnxHEglAQpFSAHixTmP8U8V7RFJIG??En3zME7

1-3.8 0.0 5-0.8 5-0.8 4-10.0 9-10.8 7-8.8 17-7.0 7-8.8 25-3.8 4-10.0 30-1.8 5-0.8 35-2.0 1-3.8
Scale = 1:57.6

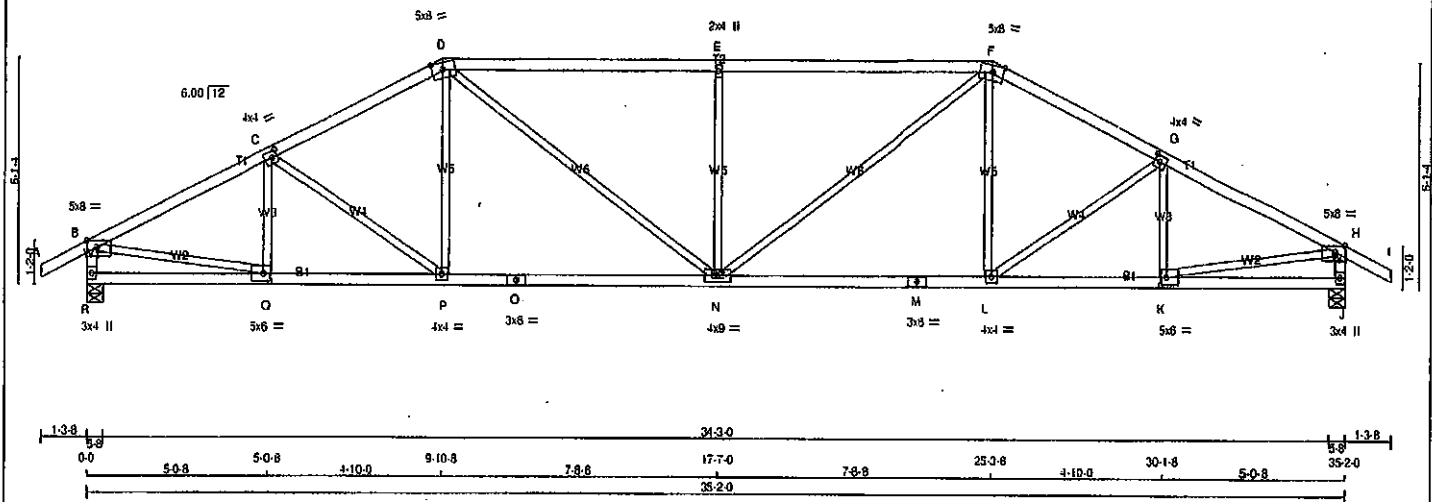

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - I	2x4	DRY	No.2	SPF	
R - B	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
R - O	2x4	DRY	No.2	SPF	
O - M	2x4	DRY	No.2	SPF	
M - J	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge 3.50
C	TMWW-t	MT20	4.0	4.0	2.00 1.75
D	TTWW-m	MT20	5.0	8.0	2.25 3.75
E	TMW+w	MT20	2.0	4.0	
F	TTWW-m	MT20	5.0	8.0	2.25 3.75
G	TMWW-t	MT20	4.0	4.0	2.00 1.75
H	TMVW-p	MT20	5.0	8.0	Edge 3.50
J	BMV1+p	MT20	3.0	4.0	
K	BMWW-t	MT20	5.0	8.0	2.50 2.00
L	BMWW-t	MT20	4.0	4.0	
M	BS-t	MT20	3.0	8.0	
N	BMWWW-t	MT20	4.0	9.0	
O	BS-t	MT20	3.0	8.0	
P	BMWW-t	MT20	4.0	4.0	
Q	BMWW-t	MT20	5.0	8.0	2.50 2.00
R	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
	VERT	HORZ	DOWN	HORZ
JT	2063	0	2063	0
R	2063	0	2063	0
J	2063	0	2063	0

UNFACTORED REACTIONS

	1ST LCASE	MAX. MIN. COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
JT	1457	969	0	0	0	488	0	0
R	1457	969	0	0	0	488	0	0
J	1457	969	0	0	0	488	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.78 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. UNBRACED LENGTH (FT)
FR-TO				FR-TO			
A-B	0 28	-91.8 -91.8 0.12 (1)	10.00	Q-C	-353 0	0.08 (1)	
B-C	-2834 0	-91.8 -91.8 0.39 (1)	3.81	C-P	-210 0	0.13 (1)	
C-D	-2687 0	-91.8 -91.8 0.37 (1)	3.91	P-D	0 246	0.06 (4)	
D-E	-3060 0	-91.8 -91.8 0.97 (1)	2.78	D-N	0 844	0.19 (1)	
E-F	-3060 0	-91.8 -91.8 0.97 (1)	2.78	N-E	-872 0	0.51 (1)	
F-G	-2687 0	-91.8 -91.8 0.37 (1)	3.91	N-F	0 844	0.19 (1)	
G-H	-2834 0	-91.8 -91.8 0.39 (1)	3.81	L-F	0 246	0.06 (4)	
H-I	0 28	-91.8 -91.8 0.12 (1)	10.00	L-G	-210 0	0.13 (1)	
R-B	-2018 0	0.0 0.0 0.20 (1)	5.94	K-G	-353 0	0.08 (1)	
J-H	-2018 0	0.0 0.0 0.20 (1)	5.94	B-Q	0 2591	0.58 (1)	
				K-H	0 2591	0.58 (1)	
R-Q	0 0	-18.5 -18.5 0.10 (4)	10.00				
Q-P	0 2555	-18.5 -18.5 0.51 (1)	10.00				
P-O	0 2386	-18.5 -18.5 0.49 (1)	10.00				
O-N	0 2386	-18.5 -18.5 0.49 (1)	10.00				
N-M	0 2386	-18.5 -18.5 0.49 (1)	10.00				
M-L	0 2386	-18.5 -18.5 0.49 (1)	10.00				
L-K	0 2555	-18.5 -18.5 0.51 (1)	10.00				
K-J	0 0	-18.5 -18.5 0.10 (4)	10.00				

TOTAL WEIGHT = 2 X 139 = 277 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6	PSF
DL	= 6.0	PSF
BOT CH. LL	= 0.0	PSF
DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.17")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.34")

CSI: TC=0.97 (1.00) (D-E:1), BC=0.51 (1.00) (P-Q:1), WB=0.58 (1.00) (B-Q:1), SS=0.34 (1.00) (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (IN)	OR (IN)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1687	788
			1887	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg

JSI GRIP=0.87 (F) (INPUT = 0.90)

JSI METAL=0.75 (M) (INPUT = 1.00)




Structural component only
DWG# T-2007663

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T43	2	1	GREEN PARK HOMES	

Tamareck Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:20:02 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-qp498dElaJYVGH01NQSJ1h?BZVAIQsVlknJVzME7h
23-3-8 35-2-0 36-5-8 1-3-8

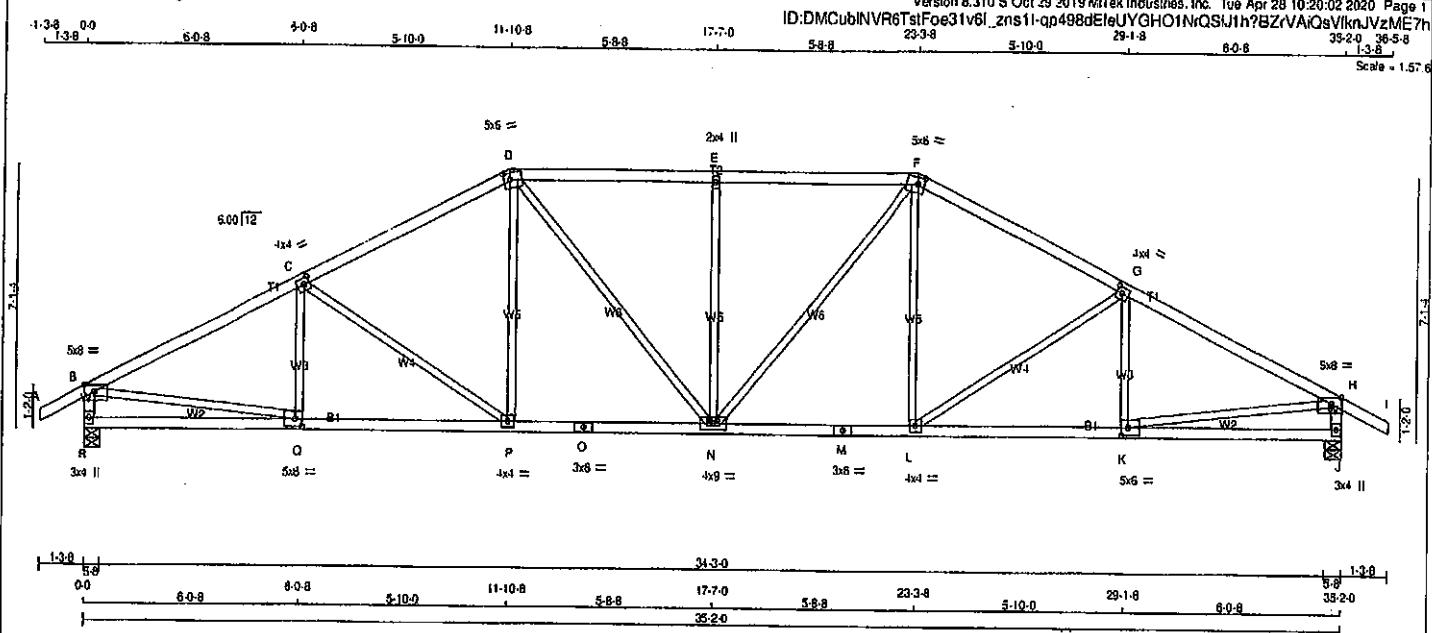

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMVW-p	MT20	5.0	8.0 Edge 3.50
C	TMVW-l	MT20	4.0	4.0 2.00 1.75
D	TTWW-m	MT20	5.0	8.0 2.25 2.00
E	TMVW-w	MT20	2.0	4.0
F	TTWW-m	MT20	5.0	8.0 2.25 2.00
G	TMVW-l	MT20	4.0	4.0 2.00 1.75
H	TMVW-p	MT20	5.0	8.0 Edge 3.50
J	BMVl+p	MT20	3.0	4.0
K	BMVW-l	MT20	5.0	8.0 2.50 2.25
L	BMVW-l	MT20	4.0	4.0
M	BS-l	MT20	3.0	6.0
N	BMVW-l	MT20	4.0	9.0
O	BS-l	MT20	3.0	6.0
P	BMVW-l	MT20	4.0	4.0
Q	BMVW-l	MT20	5.0	8.0 2.50 2.25
R	BMVl+p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
	FACTORED	MAXIMUM FACTORED	INPUT	RECORD					
	GROSS REACTION	GROSS REACTION	BRG	BRG					
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
R	2063	0	2063	0	0	5-8	5-8		
J	2063	0	2063	0	0	5-8	5-8		
UNFACTORED REACTIONS									
	1ST LOASE	MAX. MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
R	1467	989	0	0	0	0	488	0	0
J	1467	989	0	0	0	0	488	0	0
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J									
BRACING									
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.									
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.									
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.									
LOADING									
TOTAL LOAD CASES: (4)									
CHORDS									
MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX	MEMB.	MAX. FACTORED	FACTORED
	(LBS)	(PLF)			(LBS)	(LBS)		(LBS)	(LBS)
FR-TO							FR-TO		
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00	C-C	-255	12
B-C	-2889	0	-91.8	-91.8	0.59 (1)	3.58	C-P	-435	0
C-D	-2539	0	-91.8	-91.8	0.52 (1)	3.83	P-D	0	350
D-E	-2559	0	-91.8	-91.8	0.48 (1)	3.85	D-N	0	482
E-F	-2559	0	-91.8	-91.8	0.48 (1)	3.85	N-E	0	482
F-G	-2539	0	-91.8	-91.8	0.52 (1)	3.83	N-F	0	482
G-H	-2889	0	-91.8	-91.8	0.59 (1)	3.58	L-F	0	350
H-I	0	28	-91.8	-91.8	0.12 (1)	10.00	L-G	-435	0
R-B	-2014	0	0.0	0.0	0.20 (1)	5.95	K-G	-255	12
J-H	-2014	0	0.0	0.0	0.20 (1)	5.95	B-Q	0	2635
							K-H	0	2635
R-Q	0	0	-18.5	-18.5	0.15 (4)	10.00			
Q-P	0	2609	-18.5	-18.5	0.49 (1)	10.00			
P-O	0	2249	-18.5	-18.5	0.43 (1)	10.00			
O-N	0	2249	-18.5	-18.5	0.43 (1)	10.00			
N-M	0	2249	-18.5	-18.5	0.43 (1)	10.00			
M-L	0	2249	-18.5	-18.5	0.43 (1)	10.00			
L-K	0	2609	-18.5	-18.5	0.49 (1)	10.00			
K-J	0	0	-18.5	-18.5	0.15 (4)	10.00			

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF
SPACING = 24.0 IN. CG	
LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12	
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015	
THIS DESIGN COMPLIES WITH:	
- PART 9 OF CBC 2018, CBC 2012, ABC 2019	
- PART 9 OF CBC 2012 (2019 AMENDMENT)	
- CSA 888-09, CSA 888-14	
- TPIC 2011, TPIC 2014	
155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD	
ALLOWABLE DEFL.(LL) = L/360 (1.17")	
CALCULATED VERT. DEFL.(LL) = L/999 (0.15")	
ALLOWABLE DEFL.(TL) = L/360 (1.17")	
CALCULATED VERT. DEFL.(TL) = L/999 (0.28")	
CSI: TC=0.59/1.00 (H-K:1), SC=0.48/1.00 (K-L:1).	
WB=0.59/1.00 (H-K:1), SS=0.25/1.00 (D-E:1)	
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10	
COMP=1.10 SHEAR=1.10 TENS=1.10	
COMPANION LIVE LOAD FACTOR = 1.00	

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1687 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.89 (Q) INPUT = 0.90
 JSI METAL= 0.89 (M) INPUT = 1.00



Structural component only
DWG# T-2007664

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T44	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:20:03 2020 Page 1
ID:DMCubINVR6TslFoe31v6I zns1H0dXMzFwOog7vYGP7zxsEE72zACv8c7KJUKrxzME7G
28-1-8 35-2-0 38-6-8
Scale = 1:58.3

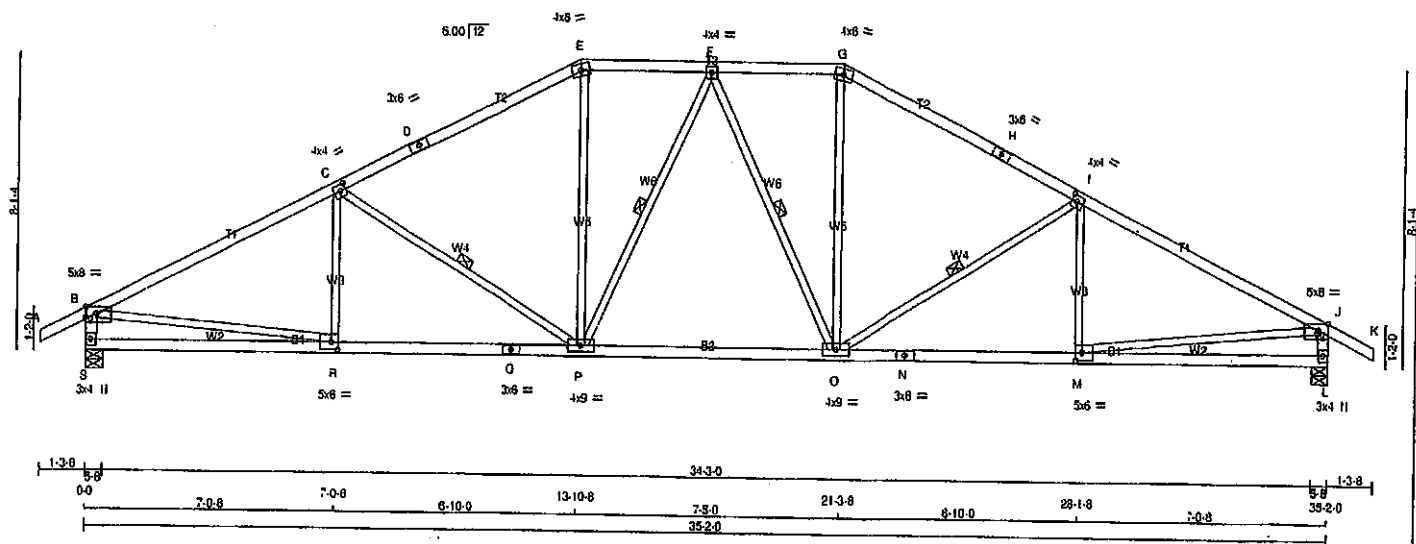

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
I - J	2x4	DRY	No.2
J - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - N	2x4	DRY	No.2
N - O	2x4	DRY	No.2
O - P	2x4	DRY	No.2
P - Q	2x4	DRY	No.2
Q - R	2x4	DRY	No.2
R - S	2x4	DRY	No.2
S - T	2x4	DRY	No.2
T - U	2x4	DRY	No.2
U - V	2x4	DRY	No.2
V - W	2x4	DRY	No.2
W - X	2x4	DRY	No.2
X - Y	2x4	DRY	No.2
Y - Z	2x4	DRY	No.2
Z - AA	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
		GROSS REACTION		GROSS REACTION		BRG		BRG	
JT		VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
S		2083	0	2083	0	0	5-8	5-8	5-8
L		2083	0	2083	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	1457	969 0	0 0	0 0	0 0	488 0	0 0
L	1457	969 0	0 0	0 0	0 0	488 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-P, F-P, F-O, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0 28	R-C	-182 52
B-C	-2908 0	C-P	-637 0
C-D	-2373 0	P-E	0 674
D-E	-2373 0	E-F	-222 0
E-F	-2100 0	F-G	0 674
F-G	-2100 0	G-H	-637 0
G-H	-2373 0	H-I	0 674
H-I	-2373 0	I-J	-182 52
I-J	-2908 0	J-K	0 2649
J-K	0 28	K-L	0 2649
K-L	-2008 0		
L-M	-2008 0		
M-N	0 0		
N-O	0 2630		
O-P	0 2630		
P-Q	0 2193		
Q-R	0 2630		
R-S	0 2630		
S-T	0 0		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.30")

CS: TC=0.83/1.00 (H:1), SC=0.52/1.00 (M:0.1), WB=0.60/1.00 (J:M:1), SSI=0.28/1.00 (B:C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.88 (M) (INPUT = 0.80)
JSI METAL = 0.79 (Q) (INPUT = 1.00)

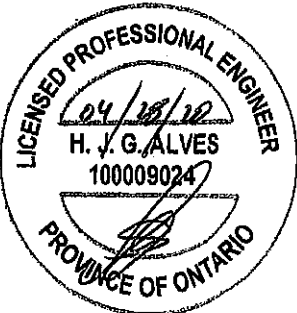

Structural component only
DWG# T-2007665

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T45	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:20:04 2020 Page 1
 ID:DMCubINVR6TslFoe31v6I_zns11-mCBvZJGY95o_KIBzrUBOSmOWNWqcd9yyDuNOzME7I
 35-2-0 35-5-8 1-3-8
 Scale = 1:50.0

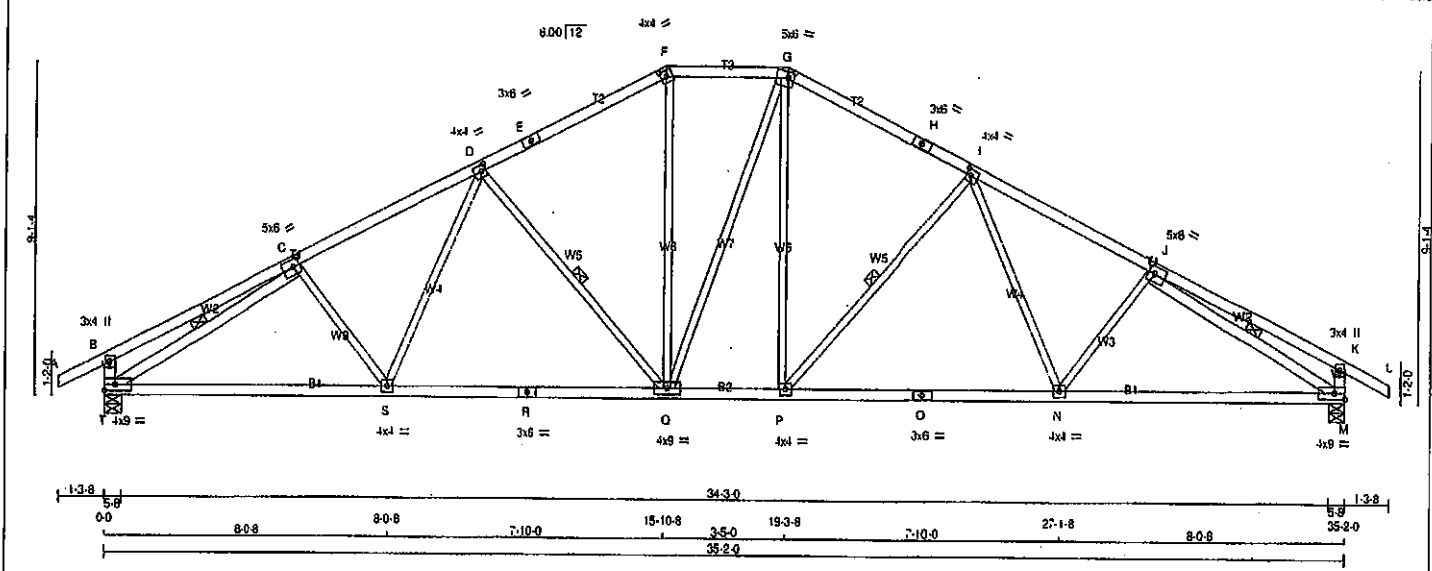

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - E	2x4	DRY	No.2
F - G	2x4	DRY	No.2
H - I	2x4	DRY	No.2
J - K	2x4	DRY	No.2
L - M	2x4	DRY	No.2
N - O	2x4	DRY	No.2
P - Q	2x4	DRY	No.2
R - S	2x4	DRY	No.2
T - U	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
V - W	2x4	DRY	No.2
X - Y	2x4	DRY	No.2
Z - AA	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y
B	TMV+p	MT20	3.0	4.0	
C	TMVW-1	MT20	5.0	6.0	2.50 2.25
D	TMVW-1	MT20	4.0	4.0	2.00 1.50
E	TS-1	MT20	3.0	6.0	
F	TTW-h	MT20	4.0	4.0	2.00 1.75
G	TTW-m	MT20	5.0	6.0	2.00 2.00
H	TS-1	MT20	3.0	6.0	
I	TMVW-1	MT20	4.0	4.0	2.00 1.50
J	TMVW-1	MT20	5.0	6.0	2.50 2.25
K	TMV+p	MT20	3.0	4.0	
L	BMVW-1	MT20	4.0	9.0	Edge
M	BMVW-1	MT20	4.0	9.0	Edge
N	P.S				
O	BMVW-1	MT20	4.0	4.0	
P	BS-1	MT20	3.0	6.0	
Q	BMVW-1	MT20	4.0	9.0	
R	BS-1	MT20	3.0	6.0	
S	BMVW-1	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	GROSS REACTION	JT	GROSS REACTION	JT	BRG	JT	BRG
T	2063 0	T	2063 0	T	5-8	T	5-8
M	2063 0	M	2063 0	M	5-8	M	5-8

UNFACTORED REACTIONS		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	JT	COMBINED
T	1457 989 0	T	1457 989 0
M	1457 989 0	M	1457 989 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, M

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.88 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.
 1 LATERAL BRACE(S) AT 1/2 LENGTH OF D-Q, I-P, C-T, J-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: 14)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	CS (LBS)	MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	CS (LBS)
A-B	0 28	-91.8	-91.8 0.12 (1)	C-S	-110 37	0.04 (1)	0.04 (1)
B-C	0 20	-91.8	-91.8 0.32 (1)	D-Q	0 276	0.08 (1)	0.08 (1)
C-D	-2760 0	-91.8	-91.8 0.40 (1)	E-F	-692 0	0.31 (1)	0.31 (1)
D-E	-2187 0	-91.8	-91.8 0.38 (1)	F-G	0 614	0.14 (1)	0.14 (1)
E-F	-2187 0	-91.8	-91.8 0.38 (1)	G-H	0 4	0.00 (1)	0.00 (1)
F-G	-1925 0	-91.8	-91.8 0.38 (1)	H-I	0 609	0.14 (1)	0.14 (1)
G-H	-2185 0	-91.8	-91.8 0.38 (1)	I-J	-683 0	0.31 (1)	0.31 (1)
H-I	-2185 0	-91.8	-91.8 0.38 (1)	J-K	0 279	0.08 (1)	0.08 (1)
I-J	-2761 0	-91.8	-91.8 0.40 (1)	K-L	-110 37	0.04 (1)	0.04 (1)
J-K	0 20	-91.8	-91.8 0.32 (1)	L-M	-3042 0	0.61 (1)	0.61 (1)
K-L	0 28	-91.8	-91.8 0.12 (1)	M-K	-3043 0	0.61 (1)	0.61 (1)
L-M	-325 0	0.0	0.0 0.03 (1)				
M-K	-325 0	0.0	0.0 0.03 (1)				
T-S	0 2537	-18.5	-18.5 0.58 (1)				
S-R	0 2383	-18.5	-18.5 0.53 (1)				
R-O	0 2383	-18.5	-18.5 0.53 (1)				
Q-P	0 1924	-18.5	-18.5 0.40 (1)				
P-O	0 2382	-18.5	-18.5 0.53 (1)				
O-N	0 2382	-18.5	-18.5 0.53 (1)				
N-M	0 2538	-18.5	-18.5 0.58 (1)				

TOTAL WEIGHT = 2 X 155 = 310 LB (M/F)

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL =	25.8 PSF
DL =	8.0 PSF
BOT CH. LL =	0.0 PSF
DL =	7.4 PSF
TOTAL LOAD =	39.0 PSF
SPACING =	24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.29")

CSI: TC=0.40/1.00 (I-J), BC=0.58/1.00 (M-N), WB=0.61/1.00 (J-M), SS=0.20/1.00 (G-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PS) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 616 354 1667 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (F) (INPUT = 0.50)
 JSI METAL = 0.83 (C) (INPUT = 1.00)



Structural component only
 DWG# T-2007666

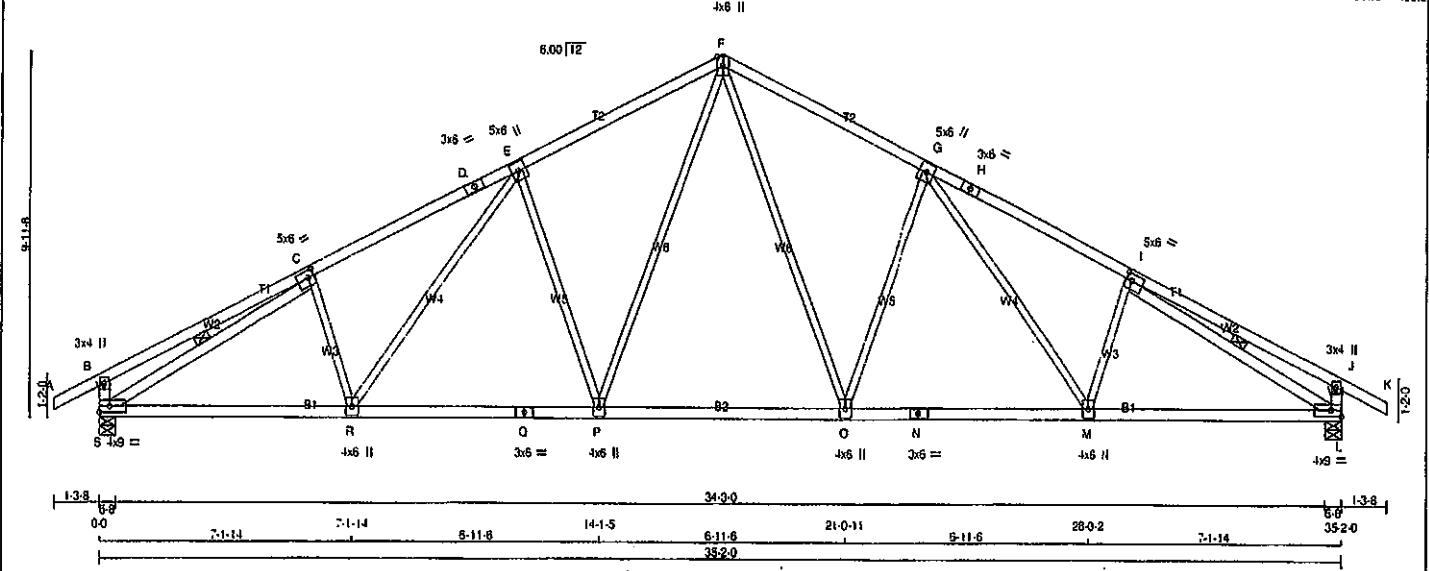

TOTAL WEIGHT = 8 X 152 = 1213 lb (M/F)

LUMBER
N. L. G. A. RULES


CHORDS	SIZE	LUMBER	DESCR
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
C	TMVW-1	MT20	5.0	6.0	2.25 2.00
D	TS-1	MT20	3.0	6.0	
E	TMVW-1	MT20	5.0	6.0	
F	TTWV+p	MT20	4.0	6.0	Edge
G	TMVW-1	MT20	5.0	6.0	
H	TS-1	MT20	3.0	6.0	
I	TMVW-1	MT20	5.0	6.0	2.25 2.00
J	TMV+p	MT20	3.0	4.0	
L	BMVW-1	MT20	4.0	9.0	Edge
M, O, P, R					
M	BMVW-1	MT20	4.0	6.0	
N	BS-1	MT20	3.0	6.0	
Q	BS-1	MT20	3.0	6.0	
S	BMVW-1	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

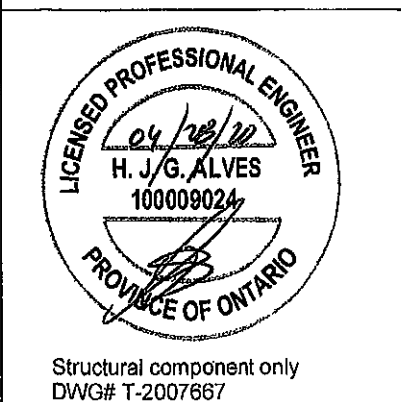

Structural component only
DWG# T-2007667

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	UP		
S	2083	0	2083	0	5-8	5-8
L	2083	0	2083	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE		MAX. MIN. COMPONENT REACTIONS		DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE		
S	1457	989	0	0	0	0
L	1457	989	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-S, L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 28	-91.8 -91.8	0.12 (1)	10.00	F-O	0 886	0.19 (1)
B-C	0 22	-91.8 -91.8	0.40 (1)	10.00	O-G	-726 0	0.72 (1)
C-D	-2808 0	-91.8 -91.8	0.49 (1)	3.75	G-M	0 391	0.09 (1)
D-E	-2808 0	-91.8 -91.8	0.49 (1)	3.75	M-I	-192 18	0.05 (1)
E-F	-2322 0	-91.8 -91.8	0.46 (1)	4.07	P-F	0 886	0.19 (1)
F-G	-2322 0	-91.8 -91.8	0.46 (1)	4.07	E-P	-726 0	0.72 (1)
G-H	-2808 0	-91.8 -91.8	0.49 (1)	3.75	R-E	0 391	0.09 (1)
H-I	-2808 0	-91.8 -91.8	0.49 (1)	3.75	C-R	-192 18	0.05 (1)
I-J	0 22	-91.8 -91.8	0.40 (1)	10.00	S-C	-3084 0	0.72 (1)
J-K	0 28	-91.8 -91.8	0.12 (1)	10.00	I-L	-3084 0	0.72 (1)
S-B	-344 0	0.0 0.0	0.03 (1)	7.81			
L-J	-344 0	0.0 0.0	0.03 (1)	7.81			
S-R	0 2574	-18.5 -18.5	0.53 (1)	10.00			
R-Q	0 2291	-18.5 -18.5	0.47 (1)	10.00			
Q-P	0 2291	-18.5 -18.5	0.47 (1)	10.00			
P-O	0 1762	-18.5 -18.5	0.39 (1)	10.00			
O-N	0 2291	-18.5 -18.5	0.47 (1)	10.00			
N-M	0 2291	-18.5 -18.5	0.47 (1)	10.00			
M-L	0 2574	-18.5 -18.5	0.53 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.28")

CSI: TC=0.39/1.00 (C-E:1), BC=0.53/1.00 (L-M:1), WB=0.72/1.00 (E-P:1), SS=0.22/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 6.0 Deg.

JSI GRIP= 0.87 (C) (INPUT = 0.90)
JSI METAL= 0.77 (I) (INPUT = 1.00)



JSI GRIP= 0.77 (H) (INPUT = 0.90)
JSI METAL= 0.30 (E) (INPUT = 1.00)



JOB NAME 408224	TRUSS NAME T48	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------


Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Matek Industries, Inc. Tue Apr 28 10:20:07 2020 Page 1

ID:DMCubINVR6TstFoe31v81 zns11-An12CLIRS0AZOAvKez1u04CyjadNr3HbhwSY_jzME7c

6-7-12 6-8-8 6-12 3-3-8 10-8-0

Scale = 1/16" = 1'-0"

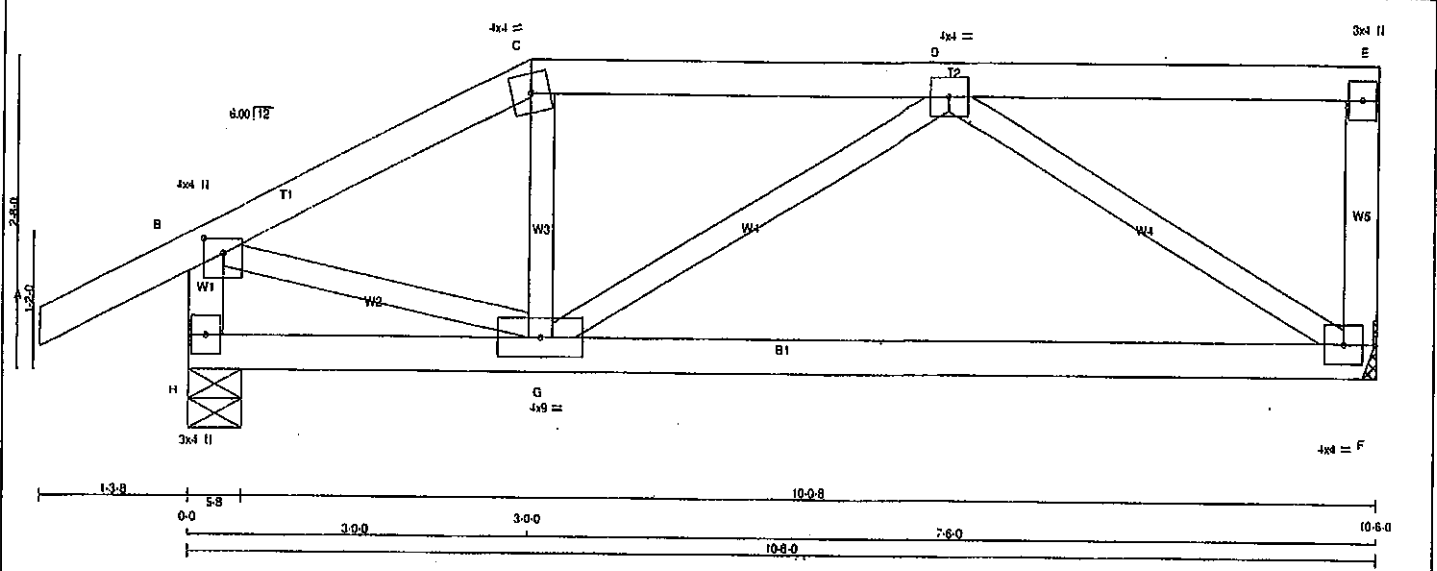

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
F - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.50	2.00
C	TTW+m	MT20	4.0	4.0		
D	TMVW-t	MT20	4.0	4.0		
E	TMV+p	MT20	3.0	4.0		
F	BMVW-t	MT20	4.0	4.0		
G	BMVW-t	MT20	4.0	4.0		
H	BMV+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UP	IN-SX
F	579	0	579	0
H	703	0	703	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1'-8".

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	409	269	0	0	0	141	0
H	495	338	0	0	0	157	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO	UNBRAC LENGTH	FR-TO			
A-B	0 28	-91.8 -91.8	0.12 (1)	10.00	G-C	0 61 0.02 (4)	
B-C	-835 0	-91.8 -91.8	0.15 (1)	6.25	G-D	-61 60 0.02 (4)	
C-D	-589 0	-91.8 -91.8	0.21 (1)	6.25	D-F	-731 0 0.23 (1)	
D-E	0 0	-91.8 -91.8	0.20 (1)	10.00	E-G	0 587 0.13 (1)	
E-F	-135 0	0.0 0.0	0.02 (1)	7.81			
F-H	-699 0	0.0 0.0	0.07 (1)	7.81			
H-G	0 0	-18.5 -18.5	0.21 (4)	10.00			
G-F	0 519	-18.5 -18.5	0.25 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L. 999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L. 999 (0.09")

CSI: TC=0.21-1.00 (C-D:1), BC=0.25-1.00 (F-G:4), WB=0.23-1.00 (D-F:1), SS=0.17-1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 768 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (B) (INPUT = 0.90)
JSI METAL= 0.23 (F) (INPUT = 1.00)




Structural component only
DWG# T-2007669

JOB NAME 408224	TRUSS NAME T49	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 \$ Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:20:08 2020 Page 1

ID:DMCubINVR6TstFoe31v6l_zns1l-ezRQPhJ3DKIQ0JUWCqZ7Zix3M_zfaUMktaB5W9zME7b

Scale = 1:22.0

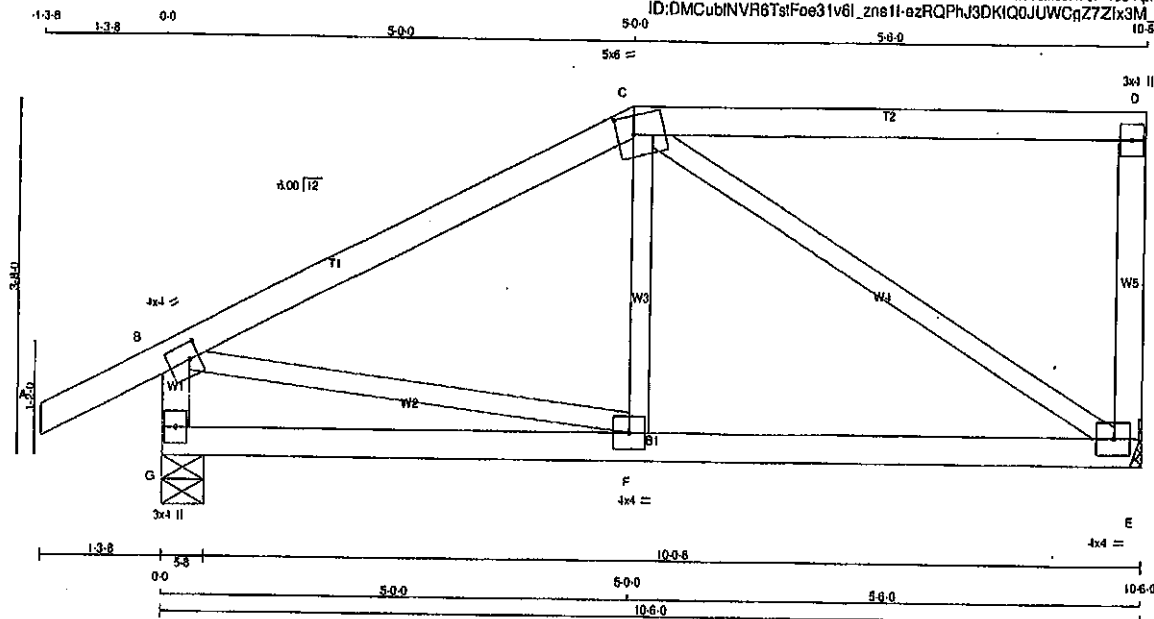

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - D	2x4	DRY	No.2	SPF		
E - D	2x4	DRY	No.2	SPF		
G - B	2x4	DRY	No.2	SPF		
G - E	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						

DRY: SEASONED LUMBER.

PLATES (tablets in inches)	W	LEN	Y	X
JT TYPE PLATES				
B TMVW-1	MT20	4.0	4.0	2.00 1.25
C TTWW-m	MT20	5.0	6.0	2.25 2.00
D TMVW-p	MT20	3.0	4.0	
E BMVW1-t	MT20	4.0	4.0	
F BMVW1-t	MT20	4.0	4.0	
G BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UPLIFT
E	579	0	579	0
G	703	0	703	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	409	269 0	0 0	0 0	0 0	141 0	0 0
G	495	338 0	0 0	0 0	0 0	157 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD LG1 MAX.	MEMB.	FORCE
(LBS)	(PLF)	CSI (LC)	(LBS)	CSI (LC)
FR-TO		FROM TO	FR-TO	
A-B	0 28	-91.8 -91.8 0.12 (1)	F-C	0 106
B-C	-523 0	-91.8 -91.8 0.41 (1)	C-E	-549 0
C-D	0 0	-91.8 -91.8 0.47 (1)	B-F	0 474
E-D	-252 0	0 0 0.05 (1)		
G-B	-667 0	0 0 0.07 (1)		
G-F	0 0	-18.5 -18.5 0.14 (4)		
F-E	0 468	-18.5 -18.5 0.19 (4)		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.35")
CALCULATED VERT. DEFL. (LL) = L/989 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.35")
CALCULATED VERT. DEFL. (TL) = L/989 (0.03")

CSI: TC=0.47 1.00 (C-D:1), BC=0.19/1.00 (E-F:4), WB=0.37 1.00 (C-E:1), SS=0.20/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (B) INPUT = 0.99
JSI METAL = 0.28 (B) INPUT = 1.00




Structural component only
DWG# T-2007670

Structural component only
DWG# T-2007671

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	G50	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 3.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:51 2020 Page 1
ID:DMCubINVR8TsiFoe31v6I_zns11-eiv?r16OD68qThFic7MikFo7CC512EzRaiQezME7s

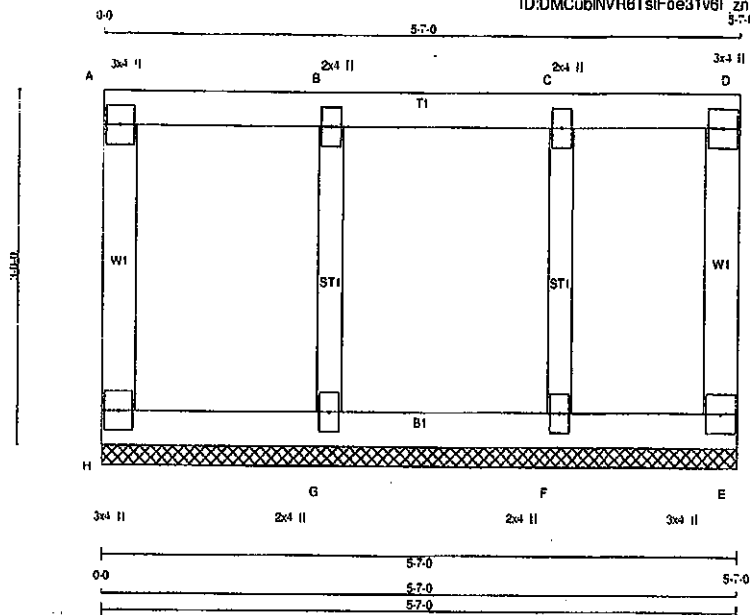

Scale = 1:18.1

LUMBER				
N. L. G. A. RULES				
CHORDS		SIZE	LUMBER	DESCR.
H - A	2x4	DRY	No.2	SPF
A - D	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF
H - E	2x4	DRY	No.2	SPF

ALL WEBS	2x3	DRY	No.2	SPF
ALL GABLE WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B	TMW+w	MT20	2.0	4.0		
C	TMW+w	MT20	2.0	4.0		
D	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		
F	BMW1+w	MT20	2.0	4.0		
G	BMW1+w	MT20	2.0	4.0		
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING.

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	UNBRAC LENGTH
H-A	-101 0	0.0	0.0 0.03 (1)	G-B	-248 0	0.08 (1)	7.81
A-B	-8 0	-114.3	-114.3 0.08 (1)	F-C	-209 0	0.05 (1)	10.00
B-C	-8 0	-114.3	-114.3 0.08 (1)				10.00
C-D	-8 0	-114.3	-114.3 0.08 (1)				10.00
E-D	-80 0	0.0	0.0 0.03 (1)				7.81
H-G	0 8	-18.5	-18.5 0.02 (4)				10.00
G-F	0 8	-18.5	-18.5 0.02 (4)				10.00
F-E	0 8	-18.5	-18.5 0.02 (4)				10.00

TOTAL WEIGHT = 22 lb (M/R)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 15.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 48.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.08/1.00 (A-B:1), BC=0.02/1.00 (G-H:1), WB=0.06/1.00 (B-G:1), SSI=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618 354 1667 788 1987 1656	


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (G) (INPUT = 0.90)
JSI METAL= 0.07 (G) (INPUT = 1.00)



Structural component only
DWG# T-2007656

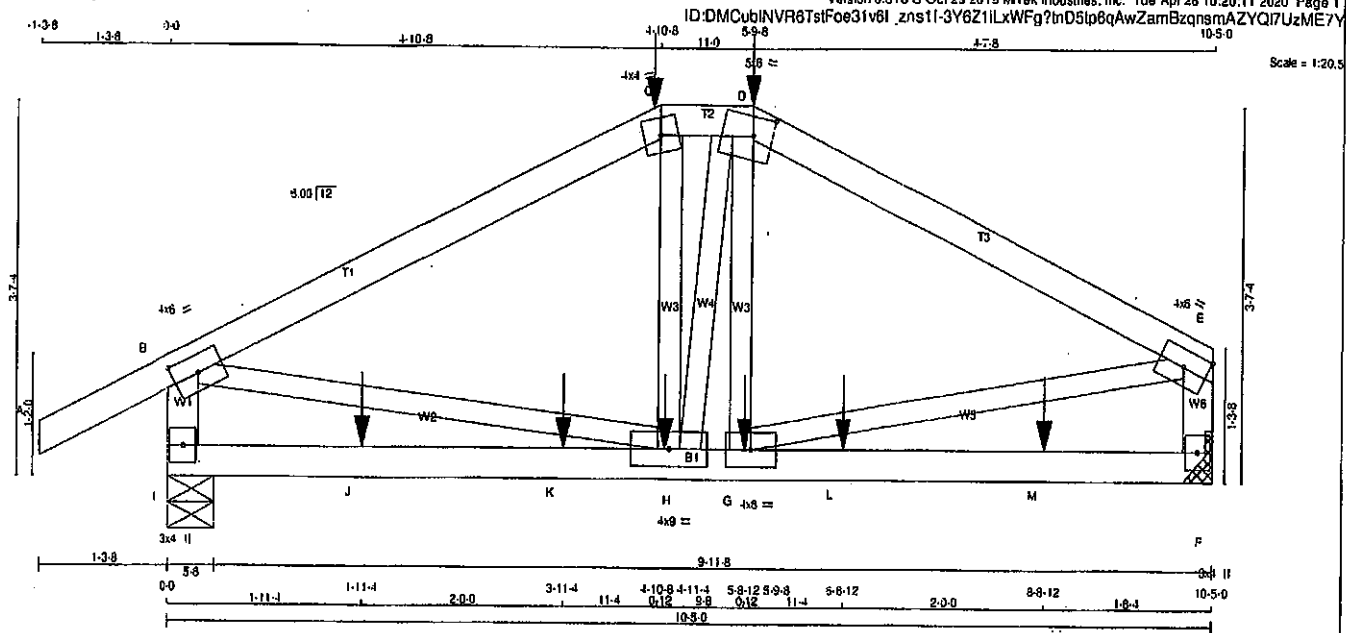


LUMBER				
N. L. G. A. RULES				
CHORDS		SIZE	LUMBER	DESCR
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
F - G	2x4	DRY	No.2	SPF
G - H	2x4	DRY	No.2	SPF
ALL WEBS		2x3	DRY	No.2
EXCEPT				SPF

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	T52	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:20:12 2020 Page 1
ID:DMCubINVR6TslFoe31v6I . zns11-XlqxF2MaHZpsUxoIRWd386gEbM8WMqKOC9JfwzME7X

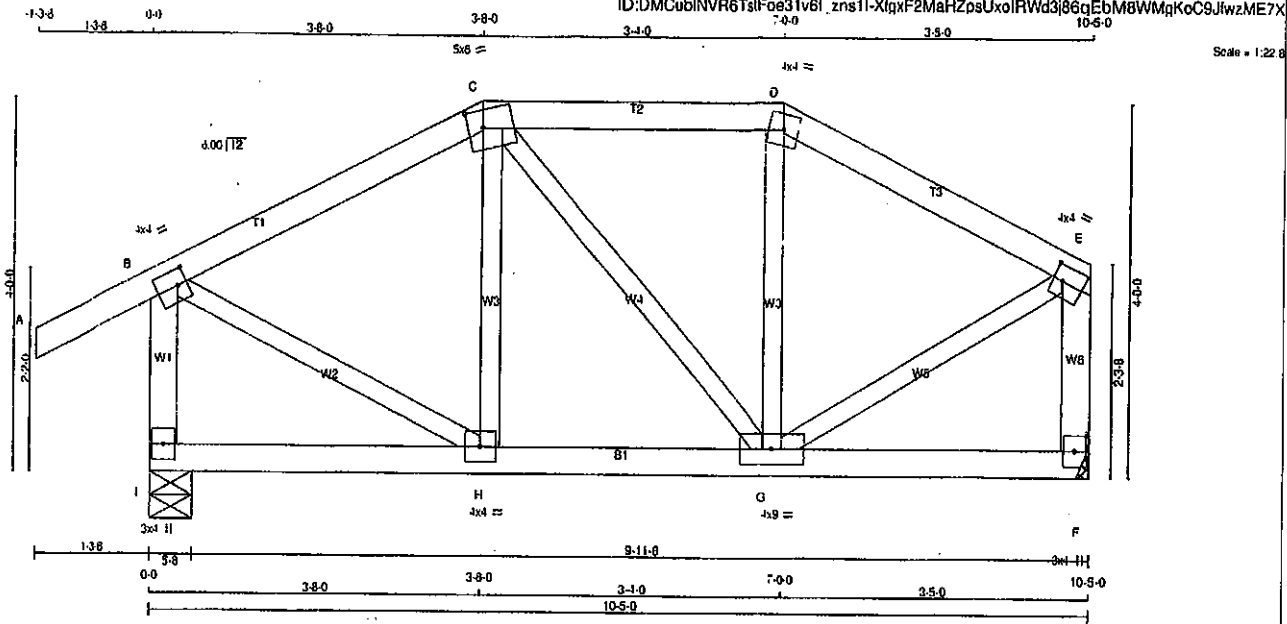

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
I - B	2x4	DRY	No.2
F - E	2x4	DRY	No.2
I - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			SPF

DRY: SEASONED LUMBER.

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-I	MT20	4.0	4.0	2.00 1.25
C	TTW-m	MT20	5.0	6.0	2.25 2.00
D	TTW-m	MT20	4.0	4.0	
E	TMVW-I	MT20	4.0	4.0	2.00 1.25
F	BMV1+p	MT20	3.0	4.0	
G	BMVW-W-I	MT20	4.0	9.0	
H	BMVW-W-I	MT20	4.0	4.0	
I	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UP
I	699	0	699	0
F	574	0	574	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

1ST LOASE	MAX/MIN COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
I	492	336	0	0	0	156	0
F	406	267	0	0	0	140	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	VERT. LOAD	LC1 MAX	MEMB.	MAX. FACTORED	VERT. LOAD	LC1 MAX
	FORCE (LBS)	(PLF)	CSI (LC)		FORCE (LBS)	(PLF)	CSI (LC)
FR-TO		FROM TO		FR-TO		FROM TO	
A-B	0 28	-91.8 -91.8	0.12 (1)	10.00	H-C	-118 14	0.03 (1)
B-C	-423 0	-91.8 -91.8	0.18 (1)	8.25	C-G	-20 0	0.01 (1)
C-D	-362 0	-91.8 -91.8	0.13 (1)	8.25	G-D	-126 8	0.03 (1)
D-E	-409 0	-91.8 -91.8	0.14 (1)	8.25	B-H	0 422	0.09 (1)
I-B	-669 0	0.0 0.0	0.08 (1)	7.81	G-E	0 419	0.09 (1)
F-E	-546 0	0.0 0.0	0.07 (1)	7.81			
I-H	0 0	-18.5 -18.5	0.05 (4)	10.00			
H-G	0 375	-18.5 -18.5	0.09 (1)	10.00			
G-F	0 0	-18.5 -18.5	0.05 (4)	10.00			

TOTAL WEIGHT = 46 lb
(MIP)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 8.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF 8CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.16/1.00 (B-C:1) , BC=0.09/1.00 (G-H:1)
WB=0.09/1.00 (B-H:1) , SS=0.12/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.65 (B) INPUT = 0.90
JSI METAL= 0.21 (B) INPUT = 1.00

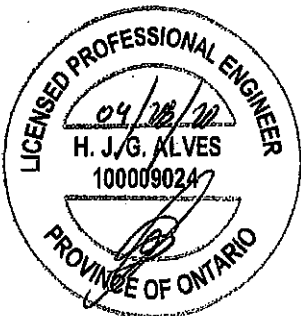

Structural component only
DWG# T-2007673

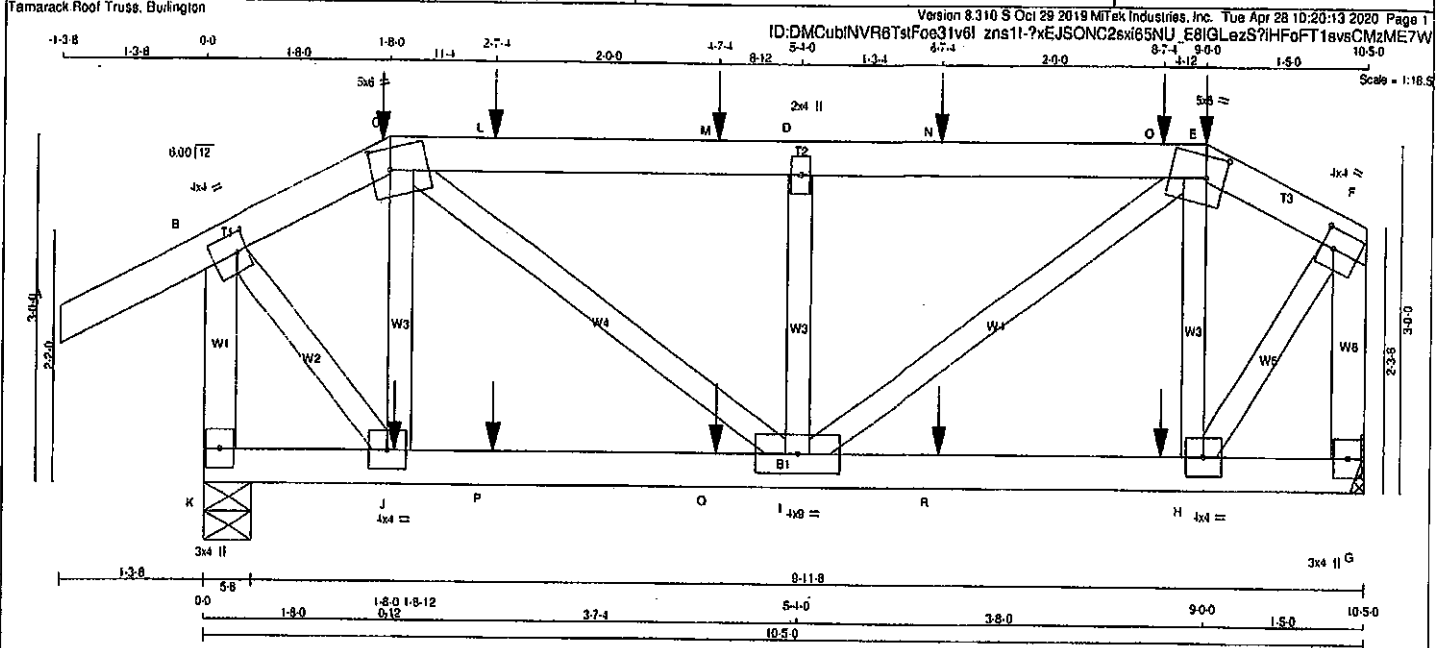

LUMBER


N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
K - B	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
K - G	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	4.0	2.00 1.25
C	TTWW-m	MT20	5.0	6.0	2.25 2.00
D	TMW-w	MT20	2.0	4.0	
E	TTWW-m	MT20	5.0	6.0	2.25 2.00
F	TMVW-1	MT20	4.0	4.0	2.00 1.25
G	BMV1-p	MT20	3.0	4.0	
H	BMVW-1	MT20	4.0	4.0	
I	BMVWW-1	MT20	4.0	9.0	
J	BMVW-1	MT20	4.0	4.0	
K	BMV1-p	MT20	3.0	4.0	

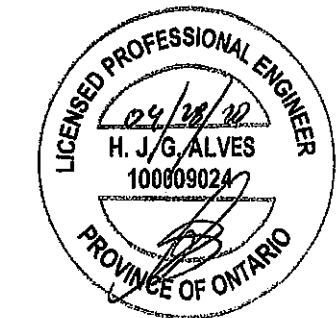

Structural component only
DWG# T-2007674

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
K	818	0	818	0	5-8	5-8
G	879	0	879	0	MECHANICAL	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 1-8.

UNFACTORED REACTIONS

1ST LOASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	578	393 0	0 0	0 0	0 0	183 0	0 0
G	480	317 0	0 0	0 0	0 0	162 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORZ. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	MAX. FACTORED TORSION (LBS-FT)
FR-TO				FR-TO			
A-B	0	-91.8	-91.8 (1)	10.00	J-C	-307	0
B-C	-427	0	-91.8	-91.8 (1)	6.25	C-I	0
C-L	-702	0	-91.8	-91.8 (1)	6.25	I-D	-472
L-M	-702	0	-91.8	-91.8 (1)	6.25	D-E	0
M-D	-702	0	-91.8	-91.8 (1)	6.25	E-H	-373
D-N	-702	0	-91.8	-91.8 (1)	6.25	H-J	0
N-O	-702	0	-91.8	-91.8 (1)	6.25	J-K	0
O-E	-702	0	-91.8	-91.8 (1)	6.25	K-F	0
E-F	-379	0	-91.8	-91.8 (1)	6.25	F-G	0
K-B	-812	0	0.0	0.0 (1)	7.81		
G-F	-877	0	0.0	0.0 (1)	7.81		
K-J	0	0	-18.5	-18.5 (1)	10.00		
J-P	0	349	-18.5	-18.5 (1)	10.00		
P-D	0	349	-18.5	-18.5 (1)	10.00		
Q-I	0	349	-18.5	-18.5 (1)	10.00		
I-R	0	324	-18.5	-18.5 (1)	10.00		
R-H	0	324	-18.5	-18.5 (1)	10.00		
H-G	0	0	-18.5	-18.5 (1)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	1-8-0	-53	-53		BACK	VERT	TOTAL		C1
E	9-0-0	-21	-21		FRONT	VERT	TOTAL		C1
H	8-7-4	-4	-4		BACK	VERT	TOTAL		C1
J	1-8-12	-4	-4		BACK	VERT	TOTAL		C1
L	2-7-4	-28	-28		BACK	VERT	TOTAL		C1
M	4-7-4	-25	-25		BACK	VERT	TOTAL		C1
N	6-7-4	-25	-25		BACK	VERT	TOTAL		C1
O	8-7-4	-53	-53		BACK	VERT	TOTAL		C1
P	2-7-4	-4	-4		BACK	VERT	TOTAL		C1
Q	4-7-4	-4	-4		BACK	VERT	TOTAL		C1
R	6-7-4	-4	-4		BACK	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, NBC 2015
- PART 9 OF NBC 2012 (2015 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD
EQUALS 25.6 P.S.F. SPECIFIED ROOF LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.35")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.35")
CALCULATED VERT. DEFL. (TL) = L/999 (0.02")

CSH TC=0.26 (D/E:1), BC=0.09 (1.00 (H:1), WB=0.14 (1.00 (F:H:1), SS=0.21 (1.00 (C:D:1)

DDL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1856


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.77 (F) INPUT = 0.90
JSI METAL = 0.22 (F) INPUT = 1.00

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T54S	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:20:14 2020 Page 1
ID:DMCubINVR6TstFoe31v6l zns11-T7ahgkOapA3ZkEygYxqXoZB2uPsf_43dGWeCkpxME7V
10-8-8
Scale = 1:10.8

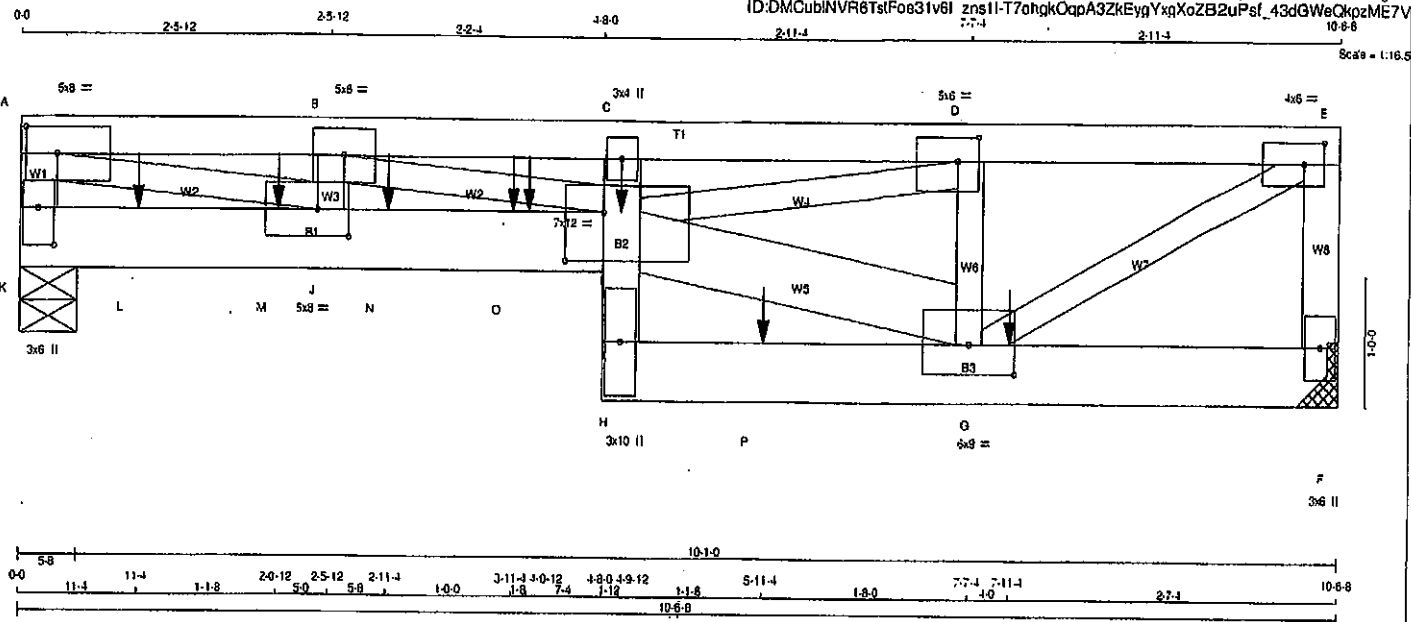

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
K - A	2x4	DRY	No.2
A - E	2x4	DRY	No.2
F - E	2x4	DRY	No.2
K - I	2x6	DRY	No.2
H - C	2x4	DRY	No.2
H - F	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
I - G	2x6	DRY	No.2

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
K-A	12	TOP
A-E	12	TOP
E-F	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
K-I	12	SIDE (81.0)
H-F	12	SIDE (183.1)
C-H	12	SIDE (89.8)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	
2x6	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIJDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
K	2804	0	2804	0
F	2255	0	2255	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F MINIMUM BEARING LENGTH AT JOINT F = 4'-0."

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	1841	1212	0	0	0	628	0
F	1592	1081	0	0	0	531	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.36 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO				FR-TO			
K-A	-2274	0	0.0	I-G	0	2889	0.19 (1)
A-B	-8594	0	-91.8	I-D	0	5928	0.73 (1)
B-C	-10298	0	-91.8	G-D	-2146	0	0.17 (1)
C-D	-9247	0	-91.8	G-E	0	4043	0.50 (1)
D-E	-3416	0	-91.8	J-B	-1577	0	0.12 (1)
F-E	-2242	0	0.0	A-J	0	7027	0.87 (1)
				B-I	0	3806	0.47 (1)
K-L	0	0	-18.5				
L-M	0	0	-18.5				
M-J	0	0	-18.5				
J-N	0	8894	-18.5				
N-O	0	8894	-18.5				
O-I	0	6694	-18.5				
H-I	0	354	0.0				
I-C	0	128	0.0				
H-P	0	832	-18.5				
P-G	0	832	-18.5				
G-F	0	0	-18.5				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
G	7-11-4	-661	-661	---	BACK	VERT	TOTAL	---
I	4-9-12	-577	-577	---	FRONT	VERT	TOTAL	---
L	11-4	-72	-72	---	BACK	VERT	TOTAL	---
M	2-0-12	-352	-352	---	FRONT	VERT	TOTAL	---
N	2-11-4	-142	-142	---	BACK	VERT	TOTAL	---
O	3-11-4	-983	-983	---	BACK	VERT	TOTAL	---
O	4-0-12	-354	-354	---	FRONT	VERT	TOTAL	---
P	5-11-4	-556	-556	---	BACK	VERT	TOTAL	---

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 49 = 98 LB

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6	PSF
DL	= 6.0	PSF
BOT CH. LL	= 0.0	PSF
DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.35")
CALCULATED VERT. DEFL. (LL) = L/862 (0.15")
ALLOWABLE DEFL. (TL) = L/360 (0.35")
CALCULATED VERT. DEFL. (TL) = L/469 (0.27")

CS: TC=0.66/1.00 (B-C:1), BC=0.79/1.00 (J-I:1), WB=0.87/1.00 (A-J:1), SS=0.45/1.00 (C-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1687
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (E) INPUT = 0.90
JSI METAL= 0.73 (D) INPUT = 1.00



Structural component only
DWG# T-2007675 1/2


CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T54S	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 5 Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:20:14 2020 Page 2
ID:DMCubINVR6TstFoe31v6l zns1f-T7ohqkQqpA3ZkEypYxXoZB2uPef 43dGWoQkpzME7v

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	5.0	8.0	2.50	3.00
B	TMVW-1	MT20	5.0	8.0		
C	TMV+p	MT20	3.0	4.0		
D	TMVW-1	MT20	5.0	6.0	2.25	2.00
E	TMVW-1	MT20	4.0	6.0	2.00	2.00
F	BMV1+p	MT20	3.0	6.0		
G	BMVWVW-1	MT20	6.0	9.0	2.75	4.50
H	BMV+p	MT20	3.0	10.0		
I	BVMWVW-1	MT20	7.0	12.0	4.50	3.75
J	BMVW-1	MT20	5.0	8.0	2.50	3.00
K	BMV1+p	MT20	3.0	6.0	3.50	1.50

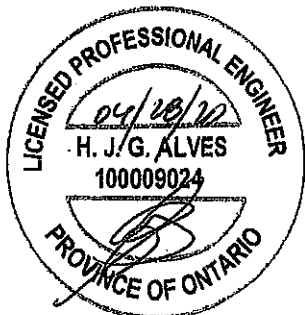


Structural component only
DWG# T-2007675

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	V1	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:00:14 2020 Page 1

ID:DMCubINVR6TsFoe31v6I zns1l-0hm5FSlyDNJdta79MsYvGLOsMVq3LML6VkvQG0zMFIV

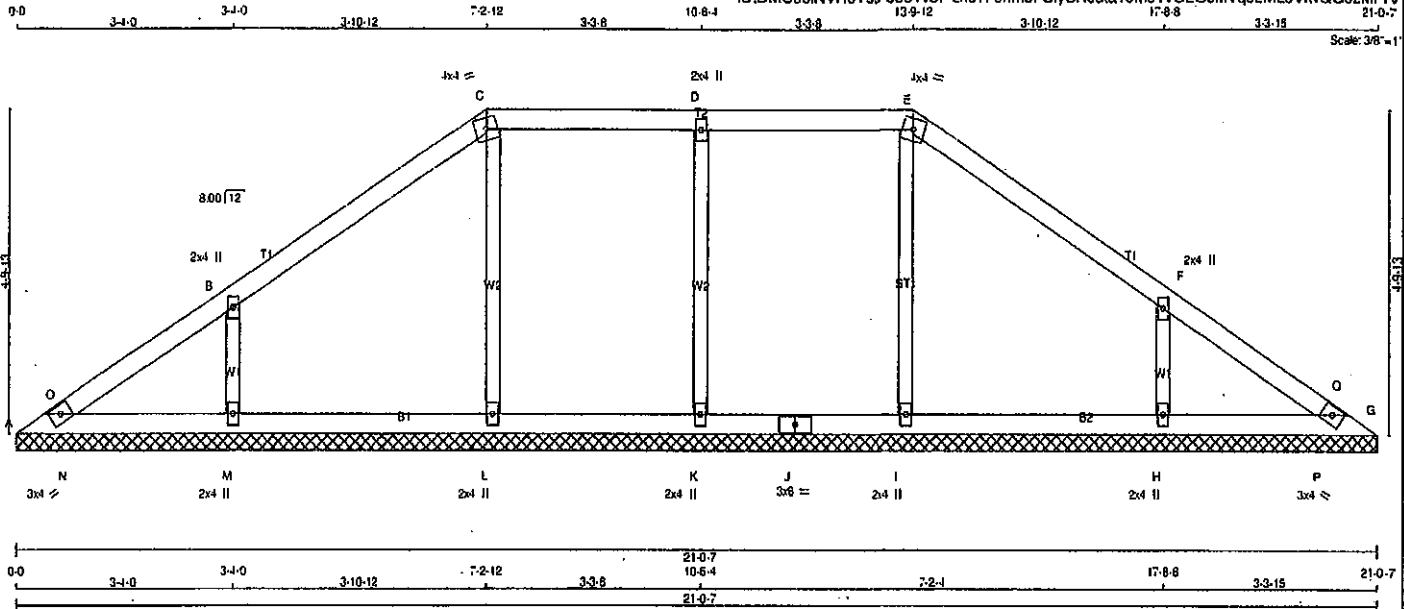

TOTAL WEIGHT = 63 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
A - J	2x4	DRY	No.2
J - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TBM1-h	MT20	3.0	4.0
B, D, F				
B	TBW+w	MT20	2.0	4.0
C	TTW-m	MT20	4.0	4.0
E	TTW-m	MT20	4.0	4.0
G	TBM1-h	MT20	3.0	4.0
H, I, K, L, M				
H	BMW+w	MT20	2.0	4.0
J	BS-1	MT20	3.0	6.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
A	128	0	128	0	0	21-0-7	11-11220-7		
G	128	0	128	0	0	21-0-7	11-11220-7		
I	330	0	330	0	0	21-0-7	11-11220-7		
L	330	0	330	0	0	21-0-7	11-11220-7		
K	433	0	433	0	0	21-0-7	11-11220-7		
H	485	0	485	0	0	21-0-7	11-11220-7		
M	485	0	485	0	0	21-0-7	11-11220-7		

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST LOSE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	90	81 0	0 0	0 0	0 0	0 0	29 0	0 0
G	90	81 0	0 0	0 0	0 0	0 0	29 0	0 0
I	235	143 0	0 0	0 0	0 0	0 0	93 0	0 0
L	235	143 0	0 0	0 0	0 0	0 0	93 0	0 0
K	304	212 0	0 0	0 0	0 0	0 0	92 0	0 0
H	342	228 0	0 0	0 0	0 0	0 0	114 0	0 0
M	342	228 0	0 0	0 0	0 0	0 0	114 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, G, I, L, K, H, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO	
A-O	-23 2	-91.8 -91.8 0.04 (1)	8.25
O-B	0 33	-91.8 -91.8 0.21 (1)	10.00
B-C	-8 8	-91.8 -91.8 0.20 (1)	10.00
C-D	0 17	-91.8 -91.8 0.17 (1)	10.00
D-E	0 17	-91.8 -91.8 0.17 (1)	10.00
E-F	-8 8	-91.8 -91.8 0.20 (1)	10.00
F-Q	0 33	-91.8 -91.8 0.21 (1)	10.00
Q-G	-23 2	-91.8 -91.8 0.04 (1)	8.25
A-N	-9 0	-18.5 -18.5 0.05 (1)	10.00
N-M	-7 7	-18.5 -18.5 0.06 (4)	10.00
M-L	-11 0	-18.5 -18.5 0.06 (4)	8.25
L-K	-17 0	-18.5 -18.5 0.05 (4)	8.25
K-J	-17 0	-18.5 -18.5 0.05 (4)	8.25
J-I	-17 0	-18.5 -18.5 0.05 (4)	8.25
I-H	-11 0	-18.5 -18.5 0.06 (4)	8.25
H-P	-7 7	-18.5 -18.5 0.06 (4)	10.00
P-G	-9 0	-18.5 -18.5 0.05 (1)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD = 39.0 PSF			

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

ISS 1/2 OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.21 1.00 (B-C:1), BC=0.06 1.00 (L-M:4), WB=0.13 1.00 (D-K:1), SSI=0.15 1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788
	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.81 (C) INPUT = 0.90
JSI METAL = 0.20 (F) INPUT = 1.00




Structural component only
DWG# T-2007618

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	V2	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 08:00:15 2020 Page 1

ID:DMCubINVR6TsiFoe31v6I zns11-UIKTTnJa hRUUKaLwZ38oYw1qu824qpFkOzaTzMFIL

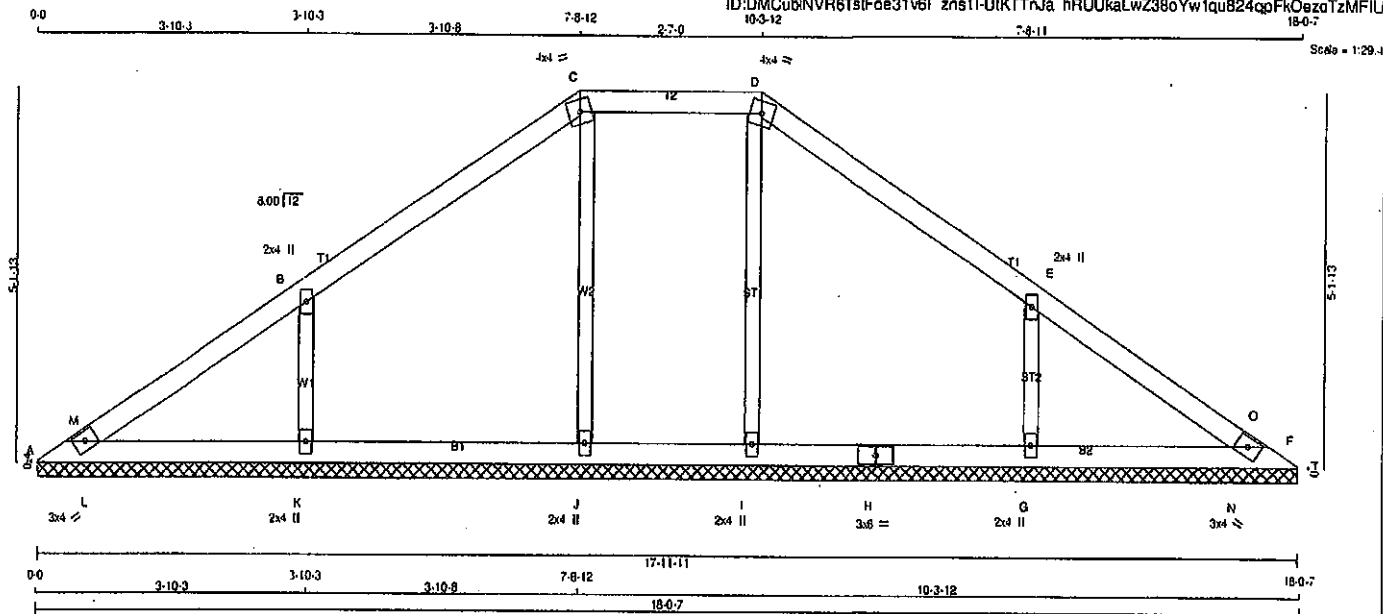

TOTAL WEIGHT = 54 lb (M)

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
A - H	2x4	DRY	No.2
H - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TBM1-h	MT20	3.0	4.0
B	TMW1-w	MT20	2.0	4.0
C	TTW1-m	MT20	4.0	4.0
D	TTW1-m	MT20	4.0	4.0
E	TMW1-w	MT20	2.0	4.0
F	TBM1-h	MT20	3.0	4.0
G, I, J, K				
G	BMW1-w	MT20	2.0	4.0
H	BS-1	MT20	3.0	6.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
A	136	0	136	0	17-11-11 (11-17-12-11)	
F	135	0	135	0	17-11-11 (11-17-12-11)	
I	344	0	344	0	17-11-11 (11-17-12-11)	
G	513	0	513	0	17-11-11 (11-17-12-11)	
J	342	0	342	0	17-11-11 (11-17-12-11)	
K	513	0	513	0	17-11-11 (11-17-12-11)	

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST CASE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
A	96	85	0	0	0	30	0
F	95	85	0	0	0	30	0
I	244	155	0	0	0	89	0
G	362	240	0	0	0	122	0
J	242	154	0	0	0	88	0
K	362	240	0	0	0	122	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS: A, F, I, G, J, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)
FR-TO				
A-M	0 20	-91.8 -91.8 0.04 (1)	10.00	1-D -292 0 0.11 (1)
M-B	0 71	-91.8 -91.8 0.22 (1)	10.00	G-E -408 0 0.07 (1)
B-C	0 33	-91.8 -91.8 0.22 (1)	10.00	J-C -291 0 0.11 (1)
C-D	0 52	-91.8 -91.8 0.11 (1)	10.00	K-B -408 0 0.07 (1)
D-E	0 33	-91.8 -91.8 0.22 (1)	10.00	L-M -71 4 0.00 (1)
E-O	0 71	-91.8 -91.8 0.22 (1)	10.00	N-O -69 5 0.00 (1)
O-F	0 19	-91.8 -91.8 0.04 (1)	10.00	
A-L	-43 0	-18.5 -18.5 0.07 (1)	6.25	
L-K	-30 0	-18.5 -18.5 0.07 (1)	6.25	
K-J	-45 0	-18.5 -18.5 0.07 (4)	6.25	
J-I	-52 0	-18.5 -18.5 0.04 (4)	6.25	
I-H	-45 0	-18.5 -18.5 0.07 (4)	6.25	
H-G	-45 0	-18.5 -18.5 0.07 (4)	6.25	
G-N	-30 0	-18.5 -18.5 0.07 (1)	6.25	
N-F	-43 0	-18.5 -18.5 0.07 (1)	6.25	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/G

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.22:1.00 (E-O:1), BC=0.07:1.00 (K-L:1), WB=0.11:1.00 (D-I:1), SSI=0.14:1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.61 (C) (INPUT = 0.90)
JSI METAL = 0.21 (E) (INPUT = 1.00)

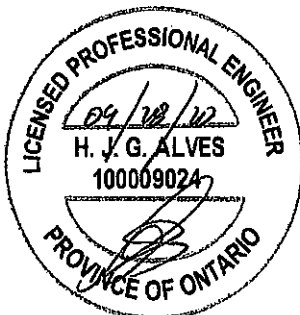


Structural component only
DWG# T-2007617

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	V3	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:00:18 2020 Page 1
ID:DMCubINVR6TsF0831v6l_zns1l-y4lrq7JCL_ZL6u9XTGaNLmTCIVXpH4Cy2OWKvzMFIT
15-0-7

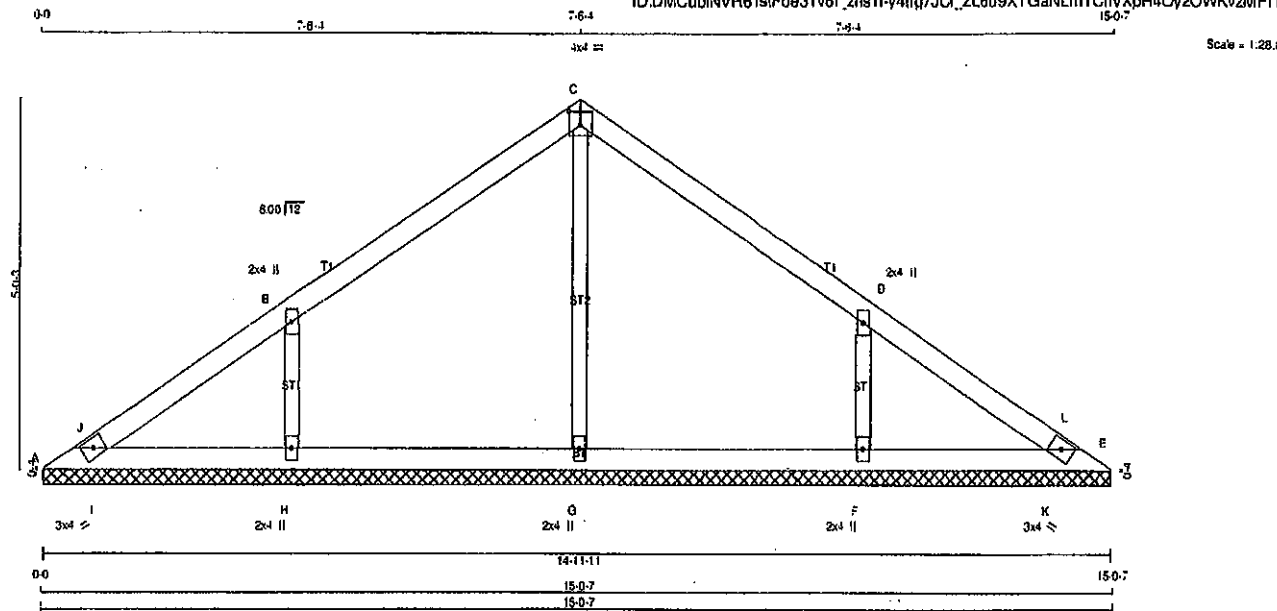

TOTAL WEIGHT = 43 lb (M)

LUMBER

N. L. G. A. RULES

CHORDS SIZE

A - C 2x4 DRY No.2

C - E 2x4 DRY No.2

A - E 2x4 DRY No.2

ALL WEBS 2x3 DRY No.2

DRY: SEASONED LUMBER.

LUMBER

SPF

SPF

SPF

DESCR.

SPF

SPF

SPF

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TBM1-h	MT20	3.0	4.0		
B	TMW-w	MT20	2.0	4.0		
C	TTW-p	MT20	4.0	4.0	2.25	2.00
D	TMW-w	MT20	2.0	4.0		
E	TBM1-h	MT20	3.0	4.0		
F, G, H						
F	BMW1-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	REQD
A	134	0	134	0	0	14-11-11	14-11-11
E	134	0	134	0	0	14-11-11	14-11-11
G	381	0	381	0	0	14-11-11	14-11-11
H	501	0	501	0	0	14-11-11	14-11-11
F	501	0	501	0	0	14-11-11	14-11-11

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
A	95	65 0 0 0 0 0 30 0 0 0
E	95	65 0 0 0 0 0 30 0 0 0
G	272	162 0 0 0 0 0 110 0 0 0
H	353	237 0 0 0 0 0 116 0 0 0
F	353	237 0 0 0 0 0 116 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS) A, E, G, H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBB			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO			FR-TO		
A-J	-20 4	-91.8 -91.8	0.04 (1)	6.25	G-Q	-316 0	0.11 (1)
J-B	0 36	-91.8 -91.8	0.22 (1)	10.00	H-B	-408 0	0.08 (1)
B-C	-5 12	-91.8 -91.8	0.21 (1)	10.00	F-D	-408 0	0.08 (1)
C-D	-5 12	-91.8 -91.8	0.21 (1)	10.00	I-J	-46 6	0.00 (1)
D-L	0 36	-91.8 -91.8	0.22 (1)	10.00	K-L	-46 6	0.00 (1)
L-E	-20 4	-91.8 -91.8	0.04 (1)	8.25			
A-I	-13 0	-18.5 -18.5	0.08 (1)	6.25			
I-H	-10 3	-18.5 -18.5	0.08 (4)	8.25			
H-G	-13 0	-18.5 -18.5	0.08 (4)	6.25			
G-F	-13 0	-18.5 -18.5	0.08 (4)	6.25			
F-K	-10 3	-18.5 -18.5	0.08 (4)	6.25			
K-E	-13 0	-18.5 -18.5	0.08 (1)	6.25			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019

- PART 9 OF OBC 2012 (2019 AMENDMENT)

- CSA 088-09, CSA 088-14

- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.22/1.00 (B-J:1), BC=0.08/1.00 (G-H:4), WB=0.11/1.00 (C-G:1), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1667	788	1987	1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.28 (D) (INPUT = 0.90)

JSI METAL = 0.21 (D) (INPUT = 1.00)

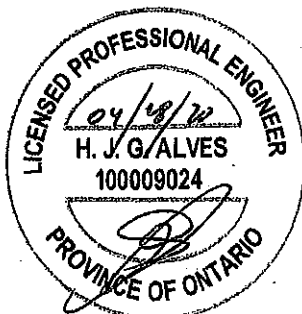

Structural component only
DWG# T-2007618

JOB NAME 408222	TRUSS NAME V4	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 28 2019 Mtek Industries, Inc. Tue Apr 28 11:37:42 2020 Page 1	
				ID:DMCubINVR6TsF0e31v6l_zrs1l-NKegA2eMCGH4MYH_g62VAKhU92Pb0QNm3IZNsPzMD_8	

LUMBER			
N.L.G.A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
A - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TBM1-h	MT20	3.0	4.0	
B	TMW-w	MT20	2.0	4.0	
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TMW-w	MT20	2.0	4.0	
E	TBM1-h	MT20	3.0	4.0	
F, G, H	BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
A	117	0	117	0	0	11-11-11	11-11-11
E	117	0	117	0	0	11-11-11	11-11-11
G	290	0	290	0	0	11-11-11	11-11-11
F	398	0	398	0	0	11-11-11	11-11-11
H	398	0	398	0	0	11-11-11	11-11-11

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
A	83	58/0	0/0	0/0	0/0	26/0	0/0
E	83	58/0	0/0	0/0	0/0	26/0	0/0
G	207	125/0	0/0	0/0	0/0	82/0	0/0
F	281	188/0	0/0	0/0	0/0	93/0	0/0
H	281	188/0	0/0	0/0	0/0	93/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, G, F, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-J	-8/5	-91.8	-91.8 0.03 (1)	10.00	G-C	-248/0	0.06 (1)
J-B	0/39	-91.8	-91.8 0.13 (1)	10.00	F-D	-314/0	0.05 (1)
B-C	0/12	-91.8	-91.8 0.13 (1)	10.00	H-B	-314/0	0.05 (1)
C-D	0/12	-91.8	-91.8 0.13 (1)	10.00	I-J	-47/4	0.00 (1)
D-L	0/39	-91.8	-91.8 0.13 (1)	10.00	K-L	-47/4	0.00 (1)
L-E	-8/5	-91.8	-91.8 0.03 (1)	10.00			
A-I	-13/0	-18.5	-18.5 0.05 (1)	6.25			
I-H	-10/0	-18.5	-18.5 0.05 (1)	10.00			
H-G	-20/0	-18.5	-18.5 0.04 (4)	6.25			
G-F	-20/0	-18.5	-18.5 0.04 (4)	6.25			
F-K	-10/0	-18.5	-18.5 0.05 (1)	10.00			
K-E	-13/0	-18.5	-18.5 0.05 (1)	6.25			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(85 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS: TC=0.13/1.00 (B-J:1), BC=0.05/1.00 (A-I:1), WB=0.08/1.00 (C-G:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1667 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.22 (D) (INPUT = 0.90)
JSI METAL= 0.16 (D) (INPUT = 1.00)

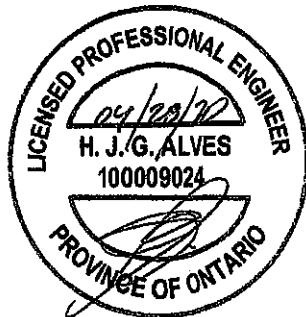


Structural component only
DWG# T-2007619

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	V5	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTX Industries, Inc. Tue Apr 28 09:00:17 2020 Page 1
ID:DMCubINVR6TstF0e31v6l_zns11-QGREITKqWthCk2kk1_6ctz?N9ip5YjBYBi74ILzMFIS

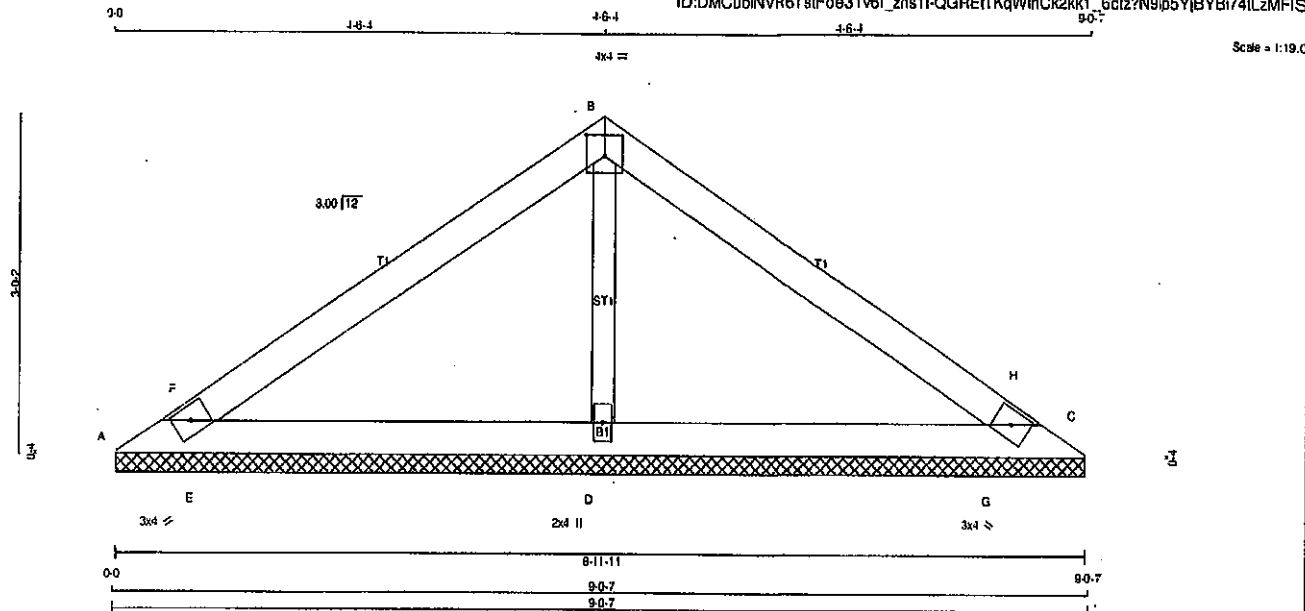

Scale = 1:19.0

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF		
B - C	2x4	DRY	No.2	SPF		
A - C	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
DRY: SEASONED LUMBER.						

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
A - TBMI-h	MT20	3.0	4.0				
B - TTW-p	MT20	4.0	4.0	2.25	2.00		
C - TBMI-h	MT20	3.0	4.0				
D - BMW1+w	MT20	2.0	4.0				

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG
	VERT	HORZ	DOWN	HORZ
A	49	0	49	0
C	49	0	49	0
D	893	0	893	0

UNFACTORED REACTIONS

JT	1ST LOSE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
A	34	22.0	0.0	0.0	0.0	12.0
C	34	22.0	0.0	0.0	0.0	12.0
D	831	415.0	0.0	0.0	0.0	216.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD LC1	MEMB.	FORCE
	(LBS)	(PLF)		(LBS)
FR-TO		FROM TO	FR-TO	
A-F	0 347	-91.8 -91.8 0.12 (1)	D-B	-698 0
F-B	0 341	-91.8 -91.8 0.23 (1)	E-F	-225 0
B-H	0 341	-91.8 -91.8 0.23 (1)	G-H	-225 0
H-C	0 347	-91.8 -91.8 0.12 (1)		
A-E	-321 0	-18.5 -18.5 0.16 (1)		
E-D	-290 0	-18.5 -18.5 0.17 (1)		
D-G	-290 0	-18.5 -18.5 0.17 (1)		
G-C	-321 0	-18.5 -18.5 0.16 (1)		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LI = 25.6 PSF
DL = 6.0 PSF
BOT CH. LI = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.23/1.00 (B-F:1), BC=0.17/1.00 (D-E:1), WB=0.12/1.00 (B-D:1), SS=0.12/1.00 (A-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.59 (B) (INPUT = 0.90)
JSI METAL= 0.20 (B) (INPUT = 1.00)

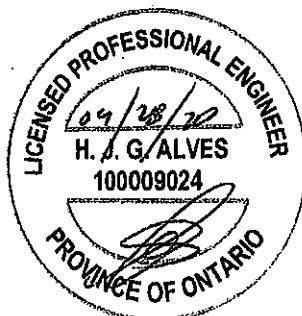


Structural component only
DWG# T-2007620

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	PB1	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:02 2020 Page 1
ID:DMCubINVR6TstFoe31v6I zns1I-MN1ZkL9Q2hoKQk4rIKK5mpuqJlFXyLks?nqzMFh

Scale = 1:18.4

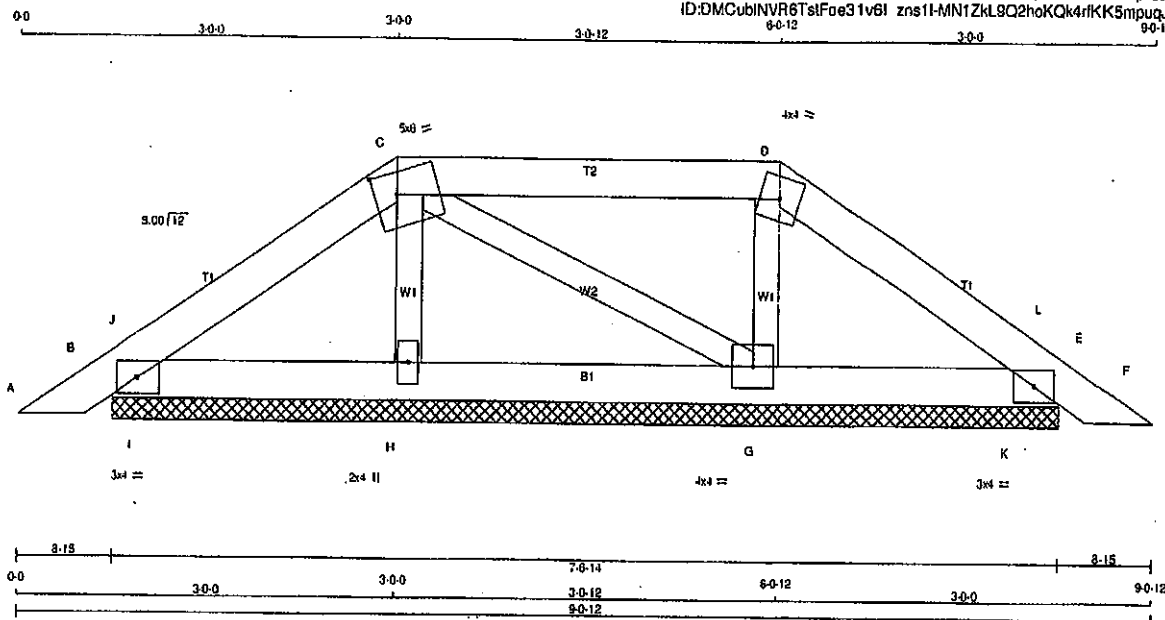

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
B - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMB1-J	MT20	3.0	4.0	
C	TTWW-m	MT20	5.0	6.0	2.00 2.00
D	TTWW-m	MT20	4.0	4.0	
E	TMB1-J	MT20	3.0	4.0	
G	BMW1-i	MT20	4.0	4.0	
H	BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	UPLIFT	IN-SX	IN-SX	BRG
B	221	0	221	0	0	7-8-14	7-8-14		
E	209	0	209	0	0	7-8-14	7-8-14		
H	248	0	248	0	0	7-8-14	7-8-14		
G	280	0	280	0	0	7-8-14	7-8-14		

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
B	154	113	0	0	0	41	0	0
E	146	108	0	0	0	39	0	0
H	176	109	0	0	0	67	0	0
G	198	127	0	0	0	71	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. (LBS)	MEMB.	FORCE (LBS)	MAX. (LBS)	MAX. (LBS)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 15	-91.8	-91.8 0.03 (1)	10.00	H-C	-178 0	0.03 (1)
B-J	-63 0	-91.8	-91.8 0.01 (1)	8.25	C-G	-21 0	0.00 (1)
J-C	-75 0	-91.8	-91.8 0.05 (1)	8.25	G-D	-198 0	0.03 (1)
C-D	-30 0	-91.8	-91.8 0.15 (1)	8.25	I-J	-121 0	0.00 (1)
D-L	-54 0	-91.8	-91.8 0.05 (1)	8.25	K-L	-123 0	0.00 (1)
L-E	-91 0	-91.8	-91.8 0.01 (1)	8.25			
E-F	0 15	-91.8	-91.8 0.03 (1)	10.00			
B-I	0 60	-18.5	-18.5 0.05 (1)	10.00			
I-H	0 60	-18.5	-18.5 0.05 (1)	10.00			
H-G	0 48	-18.5	-18.5 0.03 (1)	10.00			
G-K	0 43	-18.5	-18.5 0.05 (1)	10.00			
K-E	0 43	-18.5	-18.5 0.05 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSF: TC=0.15/1.00 (C-D:1), BC=0.06/1.00 (B-I:1), WB=0.03/1.00 (D-G:1), SS=0.11/1.00 (C-D:1)

DOL LUMBER=1.00 LUMBER=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) INPUT = 0.80 ;
JSI METAL= 0.04 (B) INPUT = 1.00 ;



Structural component only
DWG# T-2007600




JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
B	318	0	318	0	0	7-8-14	7-8-14
D	318	0	318	0	0	7-8-14	7-8-14
F	320	0	320	0	0	7-8-14	7-8-14

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	223	159 0	0 0	0 0	0 0	83 0	0 0
D	223	159 0	0 0	0 0	0 0	83 0	0 0
F	229	137 0	0 0	0 0	0 0	92 0	0 0

LOADING
TOTAL LOAD CASES: 41

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LGT. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO			FR-TO			
A-B	0 15	-91.8	-91.8	0.03 (1)	10.00	F-C	-148 0	0.03 (1)
B-H	-31 0	-91.8	-91.8	0.07 (1)	6.25	G-H	-349 0	0.00 (1)
H-C	-135 0	-91.8	-91.8	0.18 (1)	6.25	I-J	-349 0	0.00 (1)
C-J	-135 0	-91.8	-91.8	0.18 (1)	6.25			
J-D	-31 0	-91.8	-91.8	0.07 (1)	6.25			
D-E	0 15	-91.8	-91.8	0.03 (1)	10.00			
B-G	0 105	-18.5	-18.5	0.15 (1)	10.00			
G-F	0 105	-18.5	-18.5	0.15 (1)	10.00			
F-I	0 105	-18.5	-18.5	0.15 (1)	10.00			
I-D	0 105	-18.5	-18.5	0.15 (1)	10.00			

JSI GRIP= 0.28 (D) INPUT = 0.90
JSI METAL= 0.07 (D) INPUT = 1.00




JOB NAME 408223	TRUSS NAME PB20	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	---------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 3.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 26 10:03:58 2020 Page 1

ID:DMCubINVR6TstFos31v8l zns11-6 jzPKYM7hrK0xBjFY7B9Jg2AAFEry9gNMkIPVzMEMr

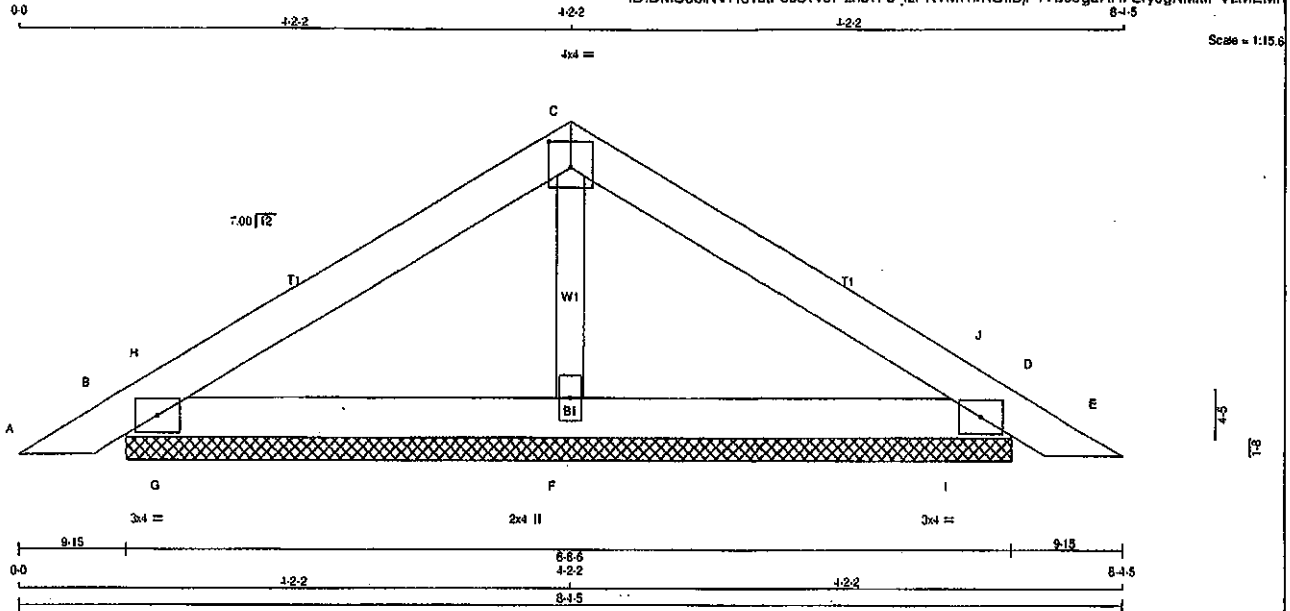

Scale = 1:15.6

TOTAL WEIGHT = 4 X 20 = 80 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
B - D	2x4	DRY	No.2	SPF
ALL WEBS 2x3 DRY No.2 SPF				
DRY: SEASONED LUMBER.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMB1-I	MT20	3.0	4.0	
C	TTW-p	MT20	4.0	3.0	2.25 2.00
D	TMB1-I	MT20	3.0	4.0	
F	BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
FACTORED				MAXIMUM FACTORED		INPUT	
GROSS REACTION				GROSS REACTION		BRG	
JT	VERT	HORZ		DOWN	HORZ	UPLIFT	IN-SX
B	281	0		281	0	0	6-8-6
D	281	0		281	0	0	6-8-6
F	314	0		314	0	0	6-8-6

UNFACTORED REACTIONS

1ST LCASE MAX. MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	197	141	0	0	0	55	0
D	197	141	0	0	0	55	0
F	224	137	0	0	0	87	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 16	-91.8 -91.8	0.04 (1)	10.00	F-C	-159 0	0.02 (1)
B-H	-44 0	-91.8 -91.8	0.05 (1)	8.25	G-H	-250 0	0.00 (1)
H-C	-99 0	-91.8 -91.8	0.12 (1)	6.25	I-J	-250 0	0.00 (1)
C-J	-99 0	-91.8 -91.8	0.12 (1)	8.25			
J-D	-44 0	-91.8 -91.8	0.05 (1)	8.25			
D-E	0 16	-91.8 -91.8	0.04 (1)	10.00			
B-G	0 81	-18.5 -18.5	0.12 (1)	10.00			
G-F	0 81	-18.5 -18.5	0.12 (1)	10.00			
F-I	0 81	-18.5 -18.5	0.12 (1)	10.00			
I-D	0 81	-18.5 -18.5	0.12 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2016, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (CH:1) , BC=0.12/1.00 (B-G:1) ,
WB=0.02/1.00 (C-F:1) , SS=0.18/1.00 (D-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1687 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.24 (D) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007627

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ORWG NO.
408223	PB21	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:03:57 2020 Page 1
ID:DMCubINVR6TstF0e31v6I zns1l-aAGLdZ u zB05lvpFeQIXDDeZbFaPRpb0UDxxzMEMm

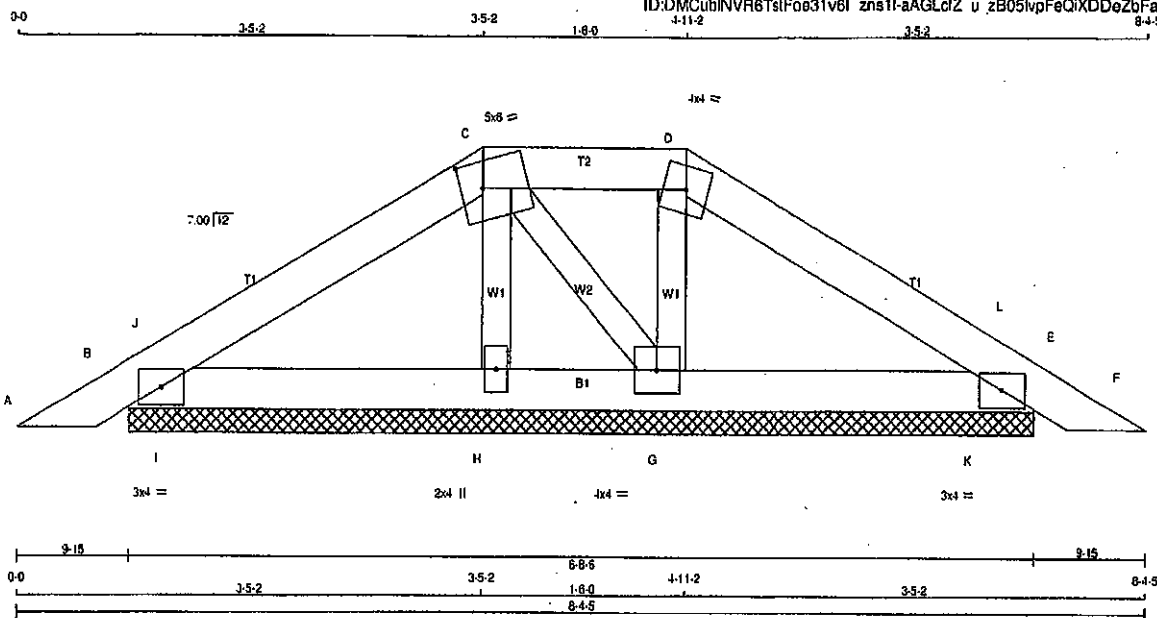

Scale = 1:15.2

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DRY
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
B - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	VERT	GROSS REACTION	HORIZ	GROSS REACTION	DOWN	UP	IN-SX	BRG	IN-SX
B	241	0	241	0	0	0	6-8-6	6-8-6	6-8-6
E	228	0	228	0	0	0	6-8-6	6-8-6	6-8-6
H	170	0	170	0	0	0	6-8-6	6-8-6	6-8-6
G	238	0	238	0	0	0	6-8-6	6-8-6	6-8-6

UNFACTORED REACTIONS

1ST LOASE		MAX. MIN. COMPONENT REACTIONS		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	COMBINED	SNOW	LIVE	PERM. LIVE
B	189	121.0	0.0	0.0	0.0	48.0	0.0	189	121.0	0.0	0.0
E	180	114.0	0.0	0.0	0.0	48.0	0.0	180	114.0	0.0	0.0
H	122	74.0	0.0	0.0	0.0	48.0	0.0	122	74.0	0.0	0.0
G	188	111.0	0.0	0.0	0.0	57.0	0.0	188	111.0	0.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)	MAX	LC1 MAX
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 16	-91.8	-91.8 0.04 (1)	10.00	H-C	-107 0	0.02 (1)
B-J	-59 0	-91.8	-91.8 0.01 (1)	6.25	C-G	-36 0	0.01 (1)
J-C	-71 0	-91.8	-91.8 0.07 (1)	6.25	G-D	-147 0	0.02 (1)
C-D	-28 0	-91.8	-91.8 0.04 (1)	6.25	I-J	-139 0	0.00 (1)
D-L	-46 0	-91.8	-91.8 0.07 (1)	8.25	K-L	-141 0	0.00 (1)
L-E	-33 0	-91.8	-91.8 0.01 (1)	6.25			
E-F	0 16	-91.8	-91.8 0.04 (1)	10.00			
B-I	0 59	-18.5	-18.5 0.07 (1)	10.00			
I-H	0 59	-18.5	-18.5 0.07 (1)	10.00			
H-G	0 52	-18.5	-18.5 0.04 (1)	10.00			
G-K	0 38	-18.5	-18.5 0.07 (1)	10.00			
K-E	0 38	-18.5	-18.5 0.07 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS DESIGN IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012: ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.07 1.00 (D-L); BC=0.07 1.00 (B-I); WB=0.02 1.00 (D-G); SSI=0.11 1.00 (E-K);

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.19 (B); INPUT = 0.90
JSI METAL = 0.05 (D); INPUT = 1.00



Structural component only.
DWG# T-2007628

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	FB22	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 3 Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:03:58 2020 Page 1	

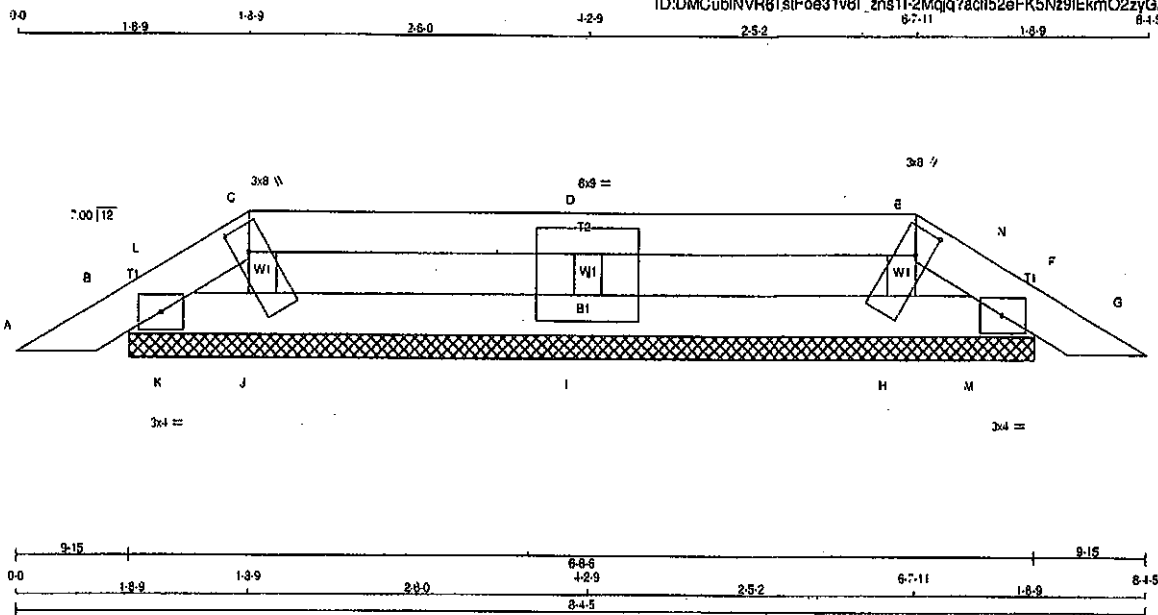

Scale = 1/16" = 1'-0"

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
B - F	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMB1-I	MT20	3.0	4.0	
C	D, E, H, I, J				
C	TTBW1-h	MT20	3.0	8.0	2.25 1.25
D	TMBMW1-I	MT20	8.0	9.0	
E	TTBW1-h	MT20	3.0	8.0	2.25 1.25
F	TMB1-I	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

		FACTORED		MAXIMUM FACTORED		INPUT	RECORD
		GROSS REACTION		GROSS REACTION		BRG	BRG
JT	VERT	HORZ		DOWN	HORZ	UPLIFT	IN-SX
B	151	0		151	0	0	0
F	152	0		152	0	0	0
J	125	0		125	0	0	0
H	120	0		120	0	0	0
I	330	0		330	0	0	0

UNFACTORED REACTIONS

	1ST LCASE	MAX./MIN. COMPONENT REACTIONS						
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
JT	COMBINED							
B	105	83	0	0	0	21	0	0
F	105	83	0	0	0	22	0	0
J	90	49	0	0	0	41	0	0
H	86	47	0	0	0	39	0	0
I	232	158	0	0	0	74	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, F, J, H, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LC1 CSI (LC)	UNBRACED LENGTH (FT)	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO						FR-TO			
A-B	0	16	-91.8	-91.8	0.04 (1)	J-C	-95	0	0.01 (1)
B-L	-53	0	-91.8	-91.8	0.04 (1)	H-E	-92	0	0.01 (1)
L-C	-22	0	-91.8	-91.8	0.01 (1)	I-D	-282	0	0.04 (1)
C-D	0	3	-91.8	-91.8	0.09 (1)	K-L	-1	12	0.00 (1)
D-E	0	3	-91.8	-91.8	0.09 (1)	M-N	0	13	0.00 (1)
E-N	-21	0	-91.8	-91.8	0.01 (1)				
N-F	-52	0	-91.8	-91.8	0.04 (1)				
F-G	0	16	-91.8	-91.8	0.04 (1)				
B-K	0	14	-18.5	-18.5	0.01 (1)				
K-J	0	14	-18.5	-18.5	0.02 (4)				
J-I	-3	0	-18.5	-18.5	0.02 (4)				
I-H	-3	0	-18.5	-18.5	0.02 (4)				
H-M	0	14	-18.5	-18.5	0.01 (4)				
M-F	0	14	-18.5	-18.5	0.01 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6:00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.09/1.00 (D-E:1), BC=0.02/1.00 (I-J:4), WB=0.04/1.00 (D-I:1), SSI=0.11/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX	MIN	MAX MIN
MT20	618	354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.13 (C) (INPUT = 0.90)
JSI METAL = 0.04 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007629

JOB NAME 408223	TRUSS NAME P20	QUANTITY 17	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	----------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:03:55 2020 Page 1
ID:DMCubINVR6TsIF0e31v6I zns1I-en8bC XkMNJUnocWiqbyd68sgmus6Uhw8i76i2zMEMo

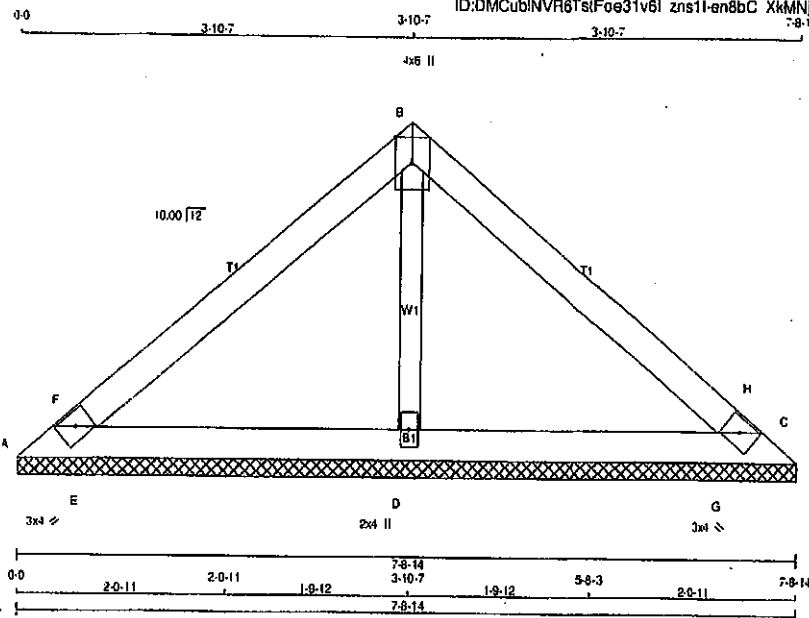

Scale = 1/20

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4 DRY	No.2	SPF
B - C	2x4 DRY	No.2	SPF
A - C	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
A	60	0	60	0	7-8-14	7-8-14
C	60	0	60	0	7-8-14	7-8-14
D	733	0	733	0	7-8-14	7-8-14

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX. MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	43	28.0	0.0	0.0	0.0	14.0	0.0
C	42	28.0	0.0	0.0	0.0	14.0	0.0
D	518	339.0	0.0	0.0	0.0	179.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS) A, C, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLP)	MAX. CS (L.C)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (L.C)	
FR-TO		FROM TO		FR-TO			
A-F	0 227	-91.8 -91.8 0.09 (1)	10.00	D-B	-558 0	0.10 (1)	
F-B	0 219	-91.8 -91.8 0.17 (1)	10.00	E-F	-199 0	0.00 (1)	
B-H	0 219	-91.8 -91.8 0.17 (1)	10.00	G-H	-199 0	0.00 (1)	
H-C	0 228	-91.8 -91.8 0.09 (1)	10.00				
A-E	-207 0	-18.5 -18.5 0.13 (1)	6.25				
E-D	-174 0	-18.5 -18.5 0.13 (1)	6.25				
D-G	-174 0	-18.5 -18.5 0.13 (1)	6.25				
G-C	-207 0	-18.5 -18.5 0.13 (1)	6.25				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.0	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD = 39.0 PSF			

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CS: TC=0.17 1.00 (B-F:1), BC=0.13/1.00 (D-E:1), WB=0.10/1.00 (B-D:1), SS=0.11/1.00 (C-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES

PLATE	GRIP (DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1867	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.29 (D) INPUT = 0.90
JSI METAL = 0.12 (D) INPUT = 1.00

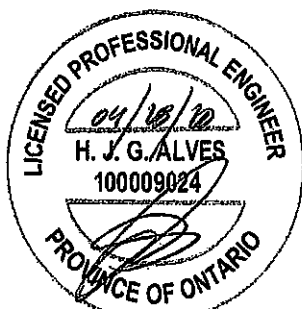

Structural component only
DWG# T-2007626

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	PG20	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:03:59 2020 Page 1	

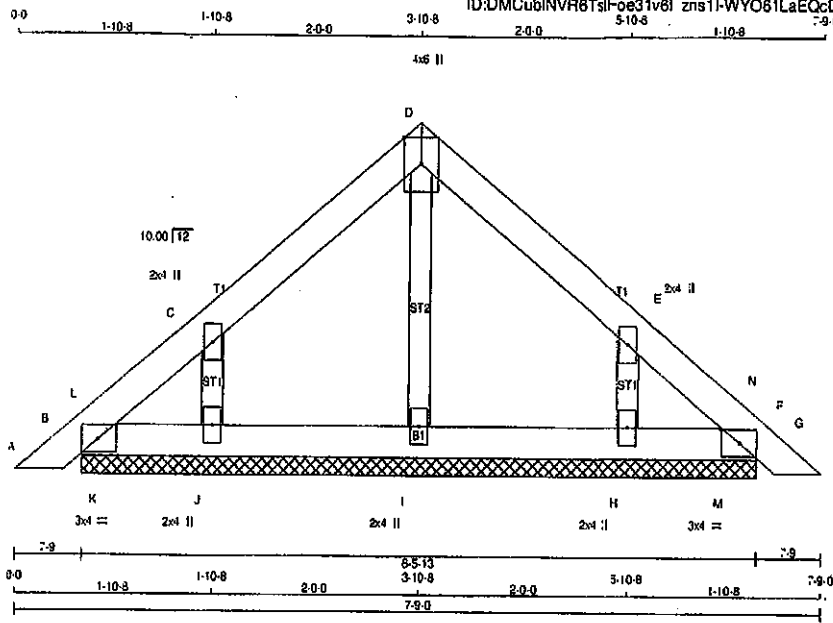

TOTAL WEIGHT = 2 X 22 = 45 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
B - F	2x4	DRY	No.2	SPF
ALL WEBS 2x3 DRY No.2 SPF				
ALL GABLE WEBS 2x3 DRY No.2 SPF				
DRY: SEASONED LUMBER				
GABLE STUDS SPACED AT 2-0-0 OC.				

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMB1-I	MT20	3.0	4.0 1.50 2.00
C	TTW+u	MT20	2.0	4.0
D	TTW+u	MT20	4.0	6.0 Edge
E	TTW+u	MT20	2.0	4.0
F	TMB1-I	MT20	3.0	4.0 1.50 2.00
H, I, J	H	BMW1+u	MT20	2.0 4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS (LC)	MAX. FACTORED UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)	MAX. FACTORED UNBRACED LENGTH (FT)	MEMB.
A-B	0 14	-91.8	-91.8 0.02 (1)	10.00	I-D	-111 0	0.02 (1)	10.00	J-C
B-L	-71 0	-91.8	-91.8 0.00 (1)	6.25	H-E	-185 0	0.03 (1)	6.25	K-L
L-C	-30 0	-91.8	-91.8 0.05 (1)	6.25	M-N	0 9	0.00 (1)	6.25	
C-D	-47 0	-91.8	-91.8 0.05 (1)	6.25					
D-E	-47 0	-91.8	-91.8 0.05 (1)	6.25					
E-N	-30 0	-91.8	-91.8 0.05 (1)	6.25					
N-F	-71 0	-91.8	-91.8 0.00 (1)	6.25					
F-G	0 14	-91.8	-91.8 0.02 (1)	10.00					
B-K	0 44	-18.5	-18.5 0.01 (1)	10.00					
K-J	0 44	-18.5	-18.5 0.01 (4)	10.00					
J-I	0 27	-18.5	-18.5 0.02 (4)	10.00					
I-H	0 27	-18.5	-18.5 0.02 (4)	10.00					
H-M	0 44	-18.5	-18.5 0.01 (4)	10.00					
M-F	0 44	-18.5	-18.5 0.01 (1)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9. NBCC 2010, NSCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CS: TC=0.05/1.00 (C-D:1), BC=0.02/1.00 (H-I:1), WB=0.03/1.00 (C-J:1), SB=0.07/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1587 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.14 (E) (INPUT = 0.90)
JSI METAL = 0.10 (C) (INPUT = 1.00)

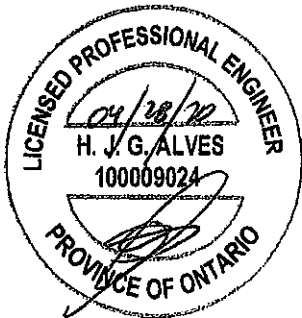


Structural component only
DWG# T-2007630

JOB NAME 408222	TRUSS NAME J1	QUANTITY 21	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	------------------	----------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:01 2020 Page 1

ID:DMCubINVR6TstFoe31v6I_zns1I-uBTBW78aHNgUpbV15dpsEbLZQFMuoV7BWCFEHhZMFII

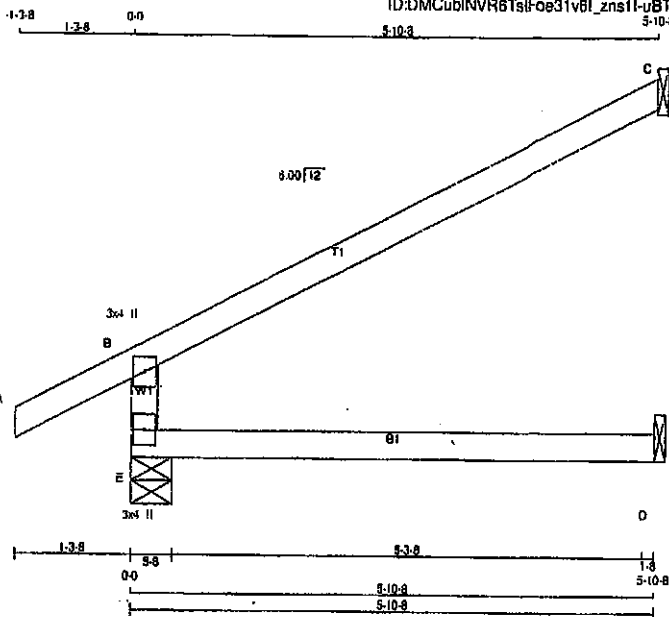

Scale = 1:22.5

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
E - B	2x4	DRY No.2
A - C	2x4	DRY No.2
E - D	2x4	DRY No.2

DRY, SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
E	525	0	525	0	5-8	5-8
C	202	0	202	0	1-8	1-8
D	45	0	50	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	COMBINED	MAX. MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	389	257	0	0	0	0	111
C	139	113	0	0	0	0	26
D	39	0	0	0	0	0	36

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)
E-B	-161	0	0	0
A-B	0	28	-91.8	-91.8
B-C	-30	0	-91.8	-91.8
E-D	0	0	-18.5	-18.5

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.1 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012, 2019 AMENDMENT
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CS: TC=0.54 (1.00 (B-C:1), BC=0.13 (1.00 (D-E:4), WB=0.00 (1.00 (1/8:0), SS=0.24 (1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP=0.19 (E) INPUT = 0.90
JSI METAL=0.13 (B) INPUT = 1.00



Structural component only
DWG# T-2007598

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	J2S	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:00:01 2020 Page 1

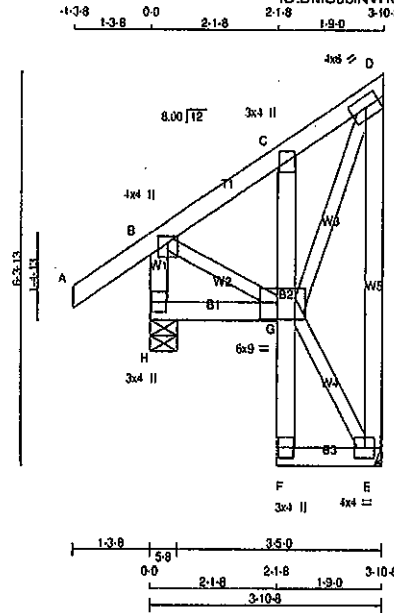

Scale = 1/4" = 1'-0"

TOTAL WEIGHT = 4 X 31 = 125 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
H - B	2x4	DRY	No.2
A - D	2x4	DRY	No.2
H - G	2x4	DRY	No.2
F - C	2x4	DRY	No.2
F - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)			
JT TYPE	PLATES	W	LEN Y X
B	TMVW+p	MT20	4.0 4.0 1.25 2.00
C	TMV+p	MT20	3.0 4.0
D	TMWW+I	MT20	4.0 8.0 2.00 2.75
E	BMVW+I	MT20	4.0 4.0
F	BMV+p	MT20	3.0 4.0
G	BVMWW+I	MT20	6.0 9.0 3.25 3.50
H	BMV+I	MT20	3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
	FACTORED	MAXIMUM FACTORED	INPUT
	GROSS REACTION	GROSS REACTION	BRG
JT	VERT	HORZ	DOWN
H	332	0	332
E	208	0	208

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1.8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	232	188	0	0	0	88	0
E	145	95	0	0	0	50	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. MAX. (LC)
H-B	-311	0	0.0 0.03 (1)
A-B	0 35	-91.8	-91.8 0.14 (5)
B-C	-98	0	-91.8 -91.8 0.05 (1)
C-D	-105	0	-91.8 -91.8 0.05 (1)
H-G	0 0	-18.5	-18.5 0.03 (4)
F-G	0 15	0.0	0.0 0.01 (1)
G-C	-202	0	0.0 0.01 (1)
F-E	0 4	-18.5	-18.5 0.01 (4)

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9. NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

+55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN (LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFLECTION (LL) = L/360 (0.19')
CALCULATED VERT. DEFLECTION (LL) = L/999 (0.00')
ALLOWABLE DEFLECTION (TL) = L/360 (0.19')
CALCULATED VERT. DEFLECTION (TL) = L/999 (0.00')

CSI: TC=0.14 (1.00 (A-B:5)), BC=0.03 (1.00 (G-H:4)), WB=0.08 (1.00 (D-E:1)), SS=0.09 (1.00 (A-B:5))

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PS) (PL) (PLI)
MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.22 (B) INPUT = 0.90
JSI METAL = 0.07 (C) INPUT = 1.00



Structural component only
DWG# T-2007599

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	J20S	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					


Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:03:51 2020 Page 1

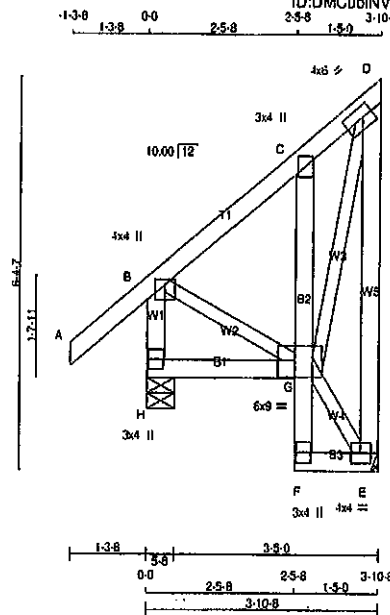

Scale = 1/32" = 1'-0"

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
H - B	2x4	DRY	No.2
H - D	2x4	DRY	No.2
H - G	2x4	DRY	No.2
F - C	2x4	DRY	No.2
F - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
E - D	2x4	DRY	No.2

PLATES (tablets in inches)			
JT TYPE	PLATES	W	LEN Y X
B	TMVW-p	MT20	4.0 4.0 1.00 2.00
C	TMV-p	MT20	3.0 4.0
D	TMVW-l	MT20	4.0 6.0 2.00 2.00
E	BMVW-l	MT20	4.0 4.0
F	BMV-p	MT20	3.0 4.0
G	BMVW-l	MT20	6.0 9.0 3.25 3.50
H	BMV-l	MT20	3.0 4.0

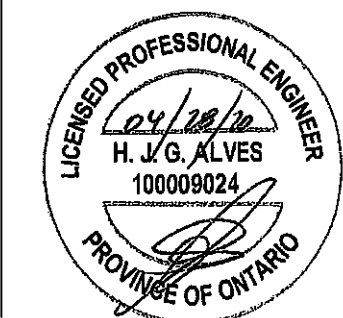

Structural component only
DWG# T-2007623

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG	IN-SX	IN-SX	
H	333	0	333	0	0	5-8	
E	208	0	208	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS							
JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD
H	233	166	0	0	0	0	67
E	145	95	0	0	0	0	50

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)
FR-TO		FROM	TO	UNBRAC LENGTH	FR-TO		
H-B	-309 0	0.0	0.0 0.03 (1)	7.81	B-G	0 70	0.02 (1)
A-B	0 41	-91.8	-91.8 0.14 (8)	10.00	E-D	-185 0	0.08 (1)
B-C	-70 0	-91.8	-91.8 0.07 (1)	6.25	G-E	-13 0	0.00 (1)
C-D	-92 0	-91.8	-91.8 0.06 (1)	6.25	G-D	0 215	0.05 (1)
H-G	0 0	-18.5	-18.5 0.04 (4)	10.00			
F-G	0 12	0.0	0.0 0.02 (1)	10.00			
G-C	-216 0	0.0	0.0 0.02 (1)	7.81			
F-E	0 8	-18.5	-18.5 0.01 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 2 X 33 = 66 lb

DESIGN CRITERIA

SPECIFIED LOADS:		
TOP CH. LL	=	25.6 PSF
DL	=	6.0 PSF
BOT CH. LL	=	0.0 PSF
DL	=	7.4 PSF
TOTAL LOAD	=	39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.14/1.00 (A-B.5), BC=0.04/1.00 (G-H.4), WB=0.08/1.00 (D-E.1), SS=0.09/1.00 (A-B.5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)	PLI	MAX MIN	MAX MIN
MT20	618	354	1667	788	1987

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (B) (INPUT = 0.90)
JSI METAL = 0.08 (C) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	U21	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:03:53 2020 Page 1
ID:DMCubINVR6TslFoe31v6l_zns1l-hP0qnlWUqmTmXUS8aPZUYh3VGyCuebnDgOW?oAzMEMq

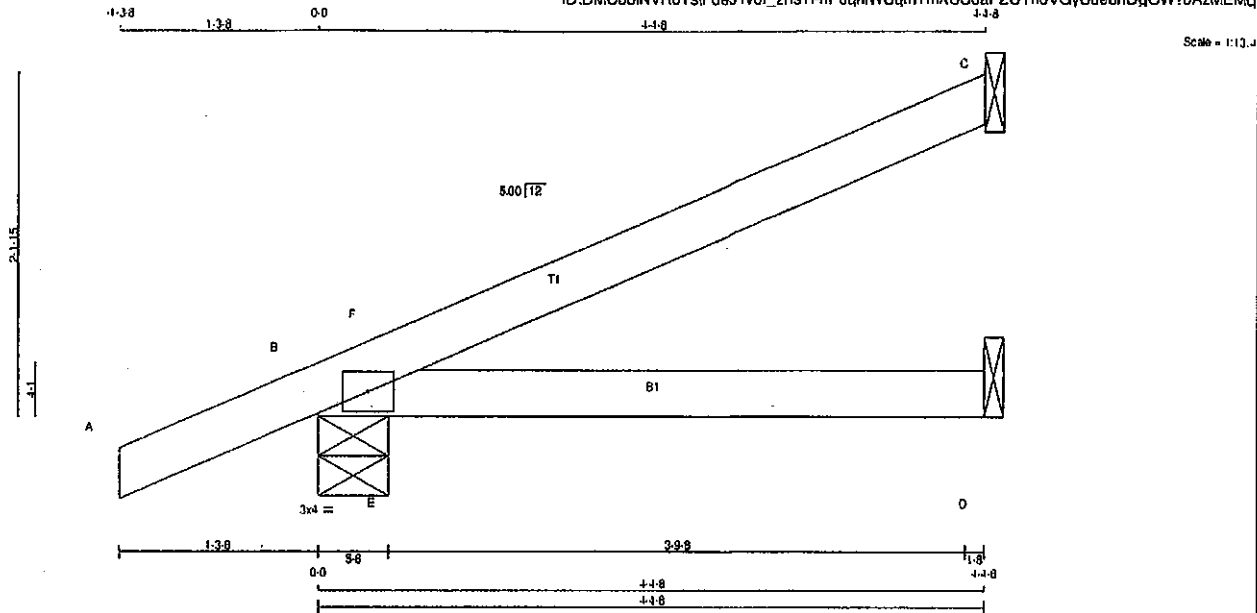

TOTAL WEIGHT = 4 X 12 = 48 lb

LUMBER					
N. L. G. A. RULES					
CHORDS	SIZE	DRY	LUMBER	QESCR.	SPF
A - C	2x4	DRY	No.2		
B - D	2x4	DRY	No.2		
DRY: SEASONED LUMBER.					

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TM81-I	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
C	175	0	175	0	0	1-8	1-8
B	365	0	365	0	0	5-8	5-8
D	67	0	67	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
COMBINED	SNOW	LIVE				
C	121	94	0	0.0	0.0	27
B	256	181	0	0.0	0.0	75
D	50	18	0	0.0	0.0	32

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE	VERT. LOAD	LCI	MEMB.	FORCE	MAX	CSH (LC)
	(LBS)	(PLF)			(LBS)		
FR-TO		FROM	TO	FR-TO			
A-B	0 23	-91.8	-91.8	10.00	E-F	-235 7	0.00 (1)
B-F	-17 13	-91.8	-91.8	0.04 (4)			8.25
F-C	-1 2	-91.8	-91.8	0.23 (1)			10.00
B-E	0 0	-18.5	-18.5	0.16 (1)			10.00
E-D	0 0	-18.5	-18.5	0.16 (1)			10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CIG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CSI: TO=0.23/1.00 (C-F:1), BC=0.18/1.00 (D-E:1),
WB=0.00/1.00 (E-F:1), SS=0.19/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	618	354	1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.26 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007624

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:03:54 2020 Page 1
F0e31v6l zns1l-AbaD eX6b3bd9e1K874j4ubgtMZPN21Nv2FYKczMEMc

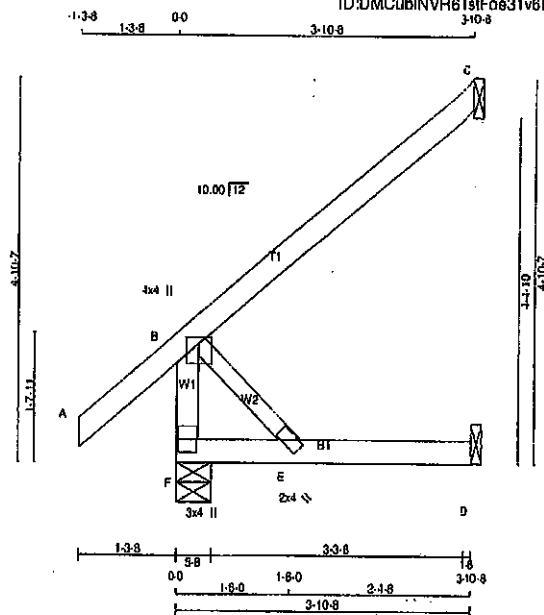

Scale = 1:27,000

TOTAL WEIGHT = 3 X 15 = 46 lb

PLATES (table is in inches)				
JT	TYPE	PLATES	W.	LEN Y X
B	TMVW+p	MT20	4.0	4.0 1.00 2.00
E	BMW+w	MT20	2.0	4.0
F	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BRIDGES DESIGNER						
BEARINGS						
JT	FACTORED		MAXIMUM FACTORED		INPUT	REQD
	GROSS REACTION		GROSS REACTION		BRG	BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
F	341	0	341	0	0	5-8
C	178	0	178	0	0	1-8
D	36	0	40	0	0	1-8

SEE MITEK STANDARD DETAIL B97781H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE		MAX-MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	239	170 0	0 0	0 0	0 0	69 0	0 0
C	122	98 0	0 0	0 0	0 0	23 0	0 0
D	29	0 0	0 0	0 0	0 0	29 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

LOADING
TOTAL LOAD CASES: (5)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)		
FR-TO		FROM TO		FR-TO					
F-B	-305 0	0.0	0.0	0.03 (1)	7.81	0 0	0.00 (1)		
A-B	0 41	-91.8	-91.8	0.14 (5)	10.00				
B-C	0 0	-91.8	-91.8	0.23 (1)	10.00				
F-E	0 0	-18.5	-18.5	0.08 (4)	10.00				
E-D	0 0	-18.5	-18.5	0.08 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD			39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD] EQUALS 25.6 P.S.F. SPECIFIED ROOF
LIVE LOAD

ALLOWABLE DEFL.(LL) = L 360 (0.19")
CALCULATED VERT. DEFL.(LL) = L 999 (0.00")
ALLOWABLE DEFL.(TL) = L 360 (0.19")
CALCULATED VERT. DEFL.(TL) = L 999 (0.01")

CSI: TC=0.23/1.00 (B-C:1) , BC=0.08/1.00 (D-E:4) ,
WB=0.00/1.00 (B-E:1) , SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)	(PLI)	(PLI)	(PLI)	(PLI)	(PLI)
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (B) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007625

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	J40	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:19:52 2020 Page 1	

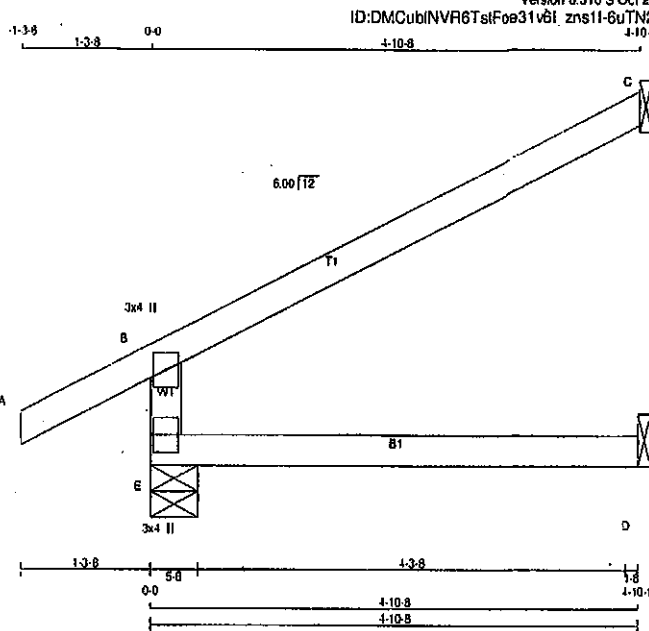

Scale = 1/20.5

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)			
JT TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0 4.0
E	BMV1+p	MT20	3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	DOWN	HORIZ	UPLIFT
E	458	0	0
C	188	0	18
D	38	0	18

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS			
1ST CASE	MAX. MIN. COMPONENT REACTIONS		
JT	COMBINED	SNOW	LIVE
E	320	225	0
C	116	94	0
D	30	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	FACTORED	FACTORED	WEBS
	FORCE	VERT. LOAD	MAX. MEMB.
	(LBS)	(PLF)	FORCE
		CS (LC)	MAX. CS (LC)
FR-TO	FROM	TO	LENGTH FR-TO
E-B	-404	0	7.81
A-B	0	-91.8	10.00
B-C	-25	-91.8	6.25
E-D	0	-18.5	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CS: TC=0.37 1.00 (B-C:1), BC=0.09/1.00 (D-E:4), WB=0.00/1.00 (A-B:0), SS=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 768 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.17 (E) (INPUT = 0.90)
JSI METAL = 0.11 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007657


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	J41	5	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:54 2020 Page 1

ID:DMCubINVR6TsIFos31v6I zns11-3Hb7Tu8HW1XPKAQn%Jq.LMmLEmLEngfPoM1zzME7p

Scale = 1:17.8

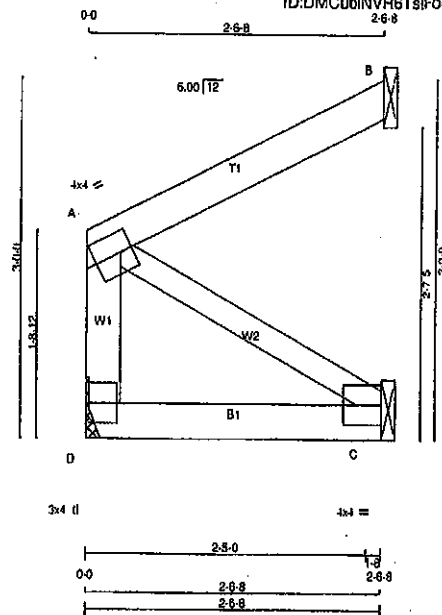

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR
D - A	2x4	DRY	No.2		SPF
A - B	2x4	DRY	No.2		SPF
D - C	2x4	DRY	No.2		SPF
ALL WEBS		2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TMVW	MT20	4.0	4.0	2.00	1.25
C	BMV1	MT20	4.0	4.0	2.00	Edge
D	BMV1	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
D	139	139	0	0
B	117	117	0	0
C	23	25	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C.

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
D	98	65	0	0	0	33	0
B	80	65	0	0	0	15	0
C	18	0	0	0	0	18	0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MEMB.	FORCE (LBS)
D-A	-117	0	A-C	0
A-B	0	0		
D-C	0	0		

TOTAL WEIGHT = 5 X 10 = 49 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPC 2011, TPC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.10/1.00 (A-B:1) , BC=0.03/1.00 (C-D:4) , WB=0.00/1.00 (A-C:1) , SSI=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.07 (A) INPUT = 0.90
JSI METAL= 0.02 (A) INPUT = 1.00




Structural component only
DWG# T-2007658

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	J42	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:55 2020 Page 1
ID:DMCubINVR6TstFoe31v6l zns1l-XT8WgE9vHKIGyK?1xSq3XYumIX 1hxqu3YvZPzME7c

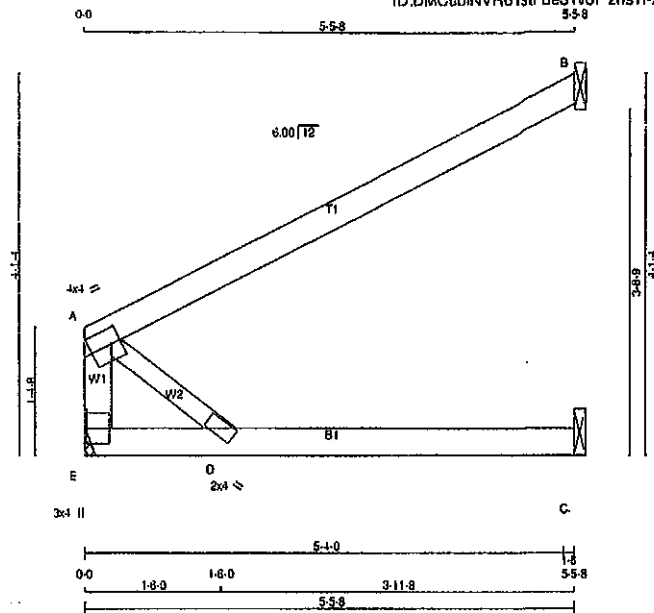

Scale = 1:22.9

<u>LUMBER</u>					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR.
E - A	2x4	DRY	No. 2	SPF	
A - B	2x4	DRY	No. 2	SPF	
E - C	2x4	DRY	No. 2	SPF	
ALL WEBS		2x3	DRY	No. 2	SPF
DRY: SEASONED LUMBER.					

<u>PLATES (tablets in inches)</u>							
JT	TYPE	PLATES	W	LEN	Y	X	
A	TMVW-1	MT20	4.0	4.0	2.00	1.25	
D	BMVW+w	MT20	2.0	4.0			
E	BMV1+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
E	301	0	301	0	0	MECHANICAL
B	250	0	250	0	0	1-8
C	50	0	57	0	0	1-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) B, C

JT	COMBINED	MAX. MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	213	140 0	0 0	0 0	0 0	73 0	0 0
B	172	140 0	0 0	0 0	0 0	33 0	0 0
C	40	0 0	0 0	0 0	0 0	40 0	0 0

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

TOTAL LOAD CASES:(4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC)		
FR-TO		FROM	TO		FR-TO				
E-A	-250 0	0.0	0.0	0.03 (1)	7.81	A-D	0 0	0.00 (1)	
A-B	0 0	-91.8	-91.8	0.46 (1)	10.00				
E-D	0 0	-18.5	-18.5	0.13 (4)	10.00				
D-C	0 0	-18.5	-18.5	0.16 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:		
TOP CH.	LL	= 25.6 PSF
	DL	= 6.0 PSF
BOT CH.	LL	= 0.0 PSF
	DL	= 7.4 PSF
TOTAL LOAD = 39.0 PSF		

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.46/1.00 (A-B:1), BC=0.16/1.00 (C-D:4), WB=0.00/1.00 (A-D:1), SS=0.17/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP(DRY)	SHEAR	SECTION	
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618	354	1667
	788	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JS1 GRIP = 0.15 (A) (INPUT = 0.90)
JS1 METAL = 0.04 (A) (INPUT = 1.00)




Structural component only
DWG# T-2007659

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	C40	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 3.310 3 Oct 2019 Mitek Industries, Inc. Tue Apr 28 10:19:42 2020 Page 1
ID:DMCubINVR6TstFoe31v6I zns11-Pzsbpyo7LL18uKVXgD50VpshpV5QUojvXujdzME8?

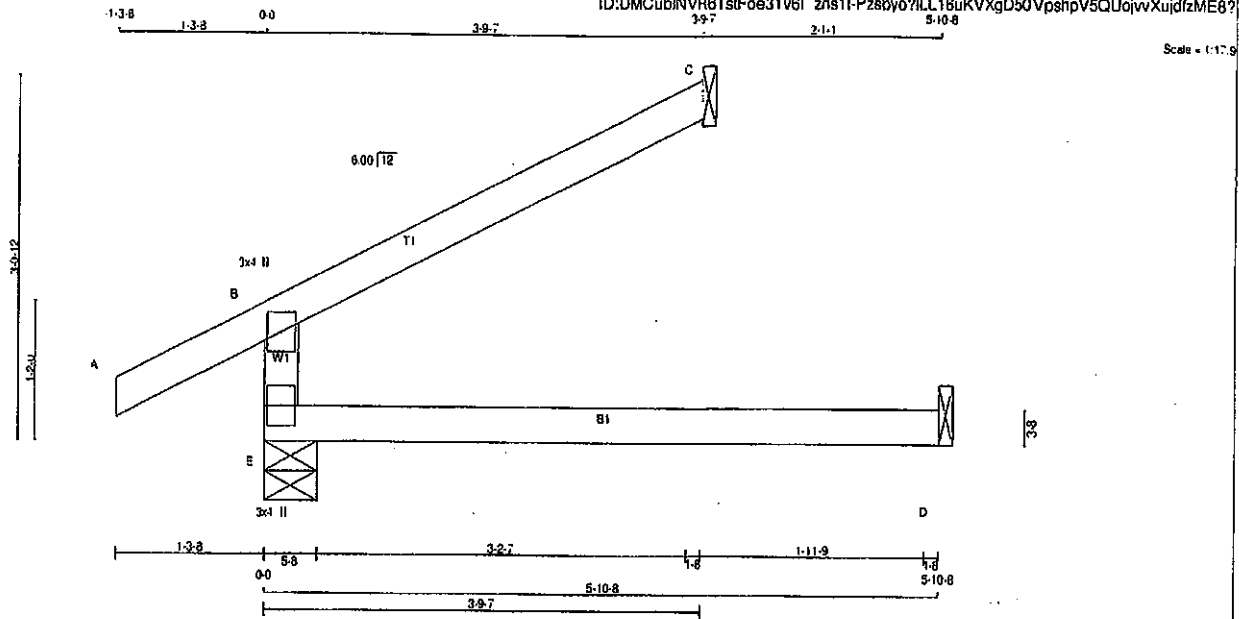

TOTAL WEIGHT = 2 X 14 = 28 lb

LUMBER

N. L. G. A. RULES			
CHORDS	SIZE		LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
E BMV+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	405	0	405	0	5-8	5-8
C	130	0	130	0	1-8	1-8
D	45	0	50	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX. MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	288	190	0	0	0	98	0
C	90	73	0	0	0	17	0
D	36	0	0	0	0	36	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)	MAX. UNBRACED LENGTH	
FR-TO		FROM TO			FR-TO				
E-B	-342 0	0.0	0.0 0.13 (4)	7.81					
A-B	0 28	-91.8	-91.8 0.12 (1)	10.00					
B-C	-19 0	-91.8	-91.8 0.22 (1)	6.25					
E-D	0 0	-18.5	-18.5 0.13 (4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CS: TC=0.22/1.00 (B-C:1), BC=0.13/1.00 (D-E:1), WB=0.00/1.00 (m/a:0), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1687	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.14 (E) INPUT = 0.90
JSI METAL = 0.09 (B) INPUT = 1.00




Structural component only
DWG# T-2007648

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	C41	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:44 2020 Page 1
ID:DMCubINVR6TsF0e3Iv8I zns1I-LM MNT0?yHq7dIv0e7UaEx3uJnoyDCMrNqgYzME7z
5-10-8

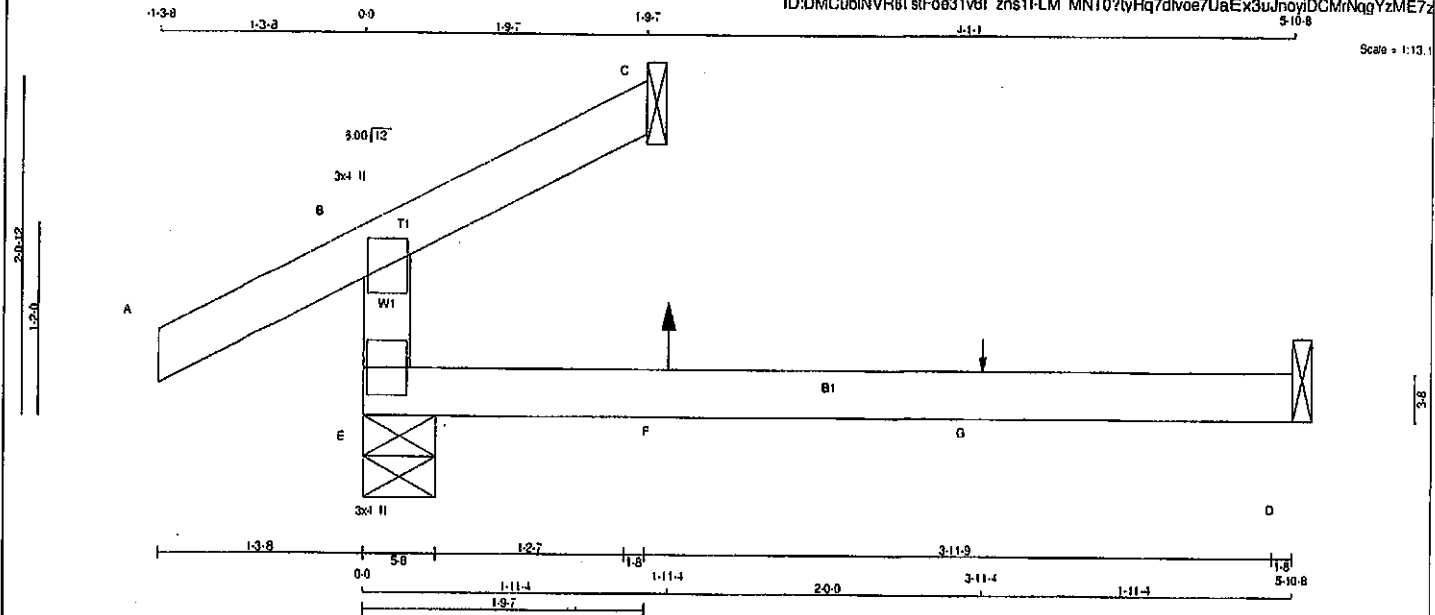

TOTAL WEIGHT = 2 X 12 = 23 LB

LUMBER						
N. L. G. A. RULES						
CHORDS		SIZE		LUMBER		DESCR.
E - B	2x4	DRY	No.2			SPF
A - C	2x4	DRY	No.2			SPF
E - D	2x4	DRY	No.2			SPF
DRY: SEASONED LUMBER.						

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B - TMV+p	MT20	3.0	4.0			
E - BMV+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG	
JT VERT HORZ	DOWN HORZ UPLIFT	IN-SX	IN-SX	
E 284 0	284 0 0	5-8	5-8	
C 63 0	63 0 0	1-8	1-8	
D 44 0	52 0 0	1-8	1-8	

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT COMBINED	MAX. MIN. COMPONENT REACTIONS						
E 200	137 0	0 0	0 0	0 0	62 0	0 0	
C 46	21 0	0 0	0 0	0 0	25 0	0 0	
D 35	0 -3	0 0	0 0	0 0	37 0	0 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (7)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1 MAX. (PLF)	CS1 (LC) UNBRAC LENGTH FR-TO	MEMB. FORCE MAX (LBS) CS1 (LC)
FR-TO		FROM TO		
E-B	-227 0	0.0 0.0 0.11 (4)	7.81	
A-B	0 28	-91.8 -91.8 0.12 (1)	10.00	
B-C	-9 9	-91.8 -91.8 0.08 (4)	10.00	
E-F	0 0	-18.5 -18.5 0.14 (4)	10.00	
F-G	0 0	-18.5 -18.5 0.14 (4)	10.00	
G-D	0 0	-18.5 -18.5 0.14 (4)	10.00	

FACTORED CONCENTRATED LOADS (LBS)	JT LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
F 1-11-4	7	1	12	BACK	VERT	TOTAL	...	C1	
G 3-11-4	1	1	12	BACK	VERT	TOTAL	...	C1	

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/989 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/989 (0.04")

CS1: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4), WB=0.00/1.00 (F-G:0), SS1=0.09/1.00 (A-B:1)

DOL LUMBER=0.98 NAIL=0.98 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (E) INPUT = 0.80
JSI METAL = 0.06 (B) INPUT = 1.00




Structural component only
DWG# T-2007649

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	C42	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:45 2020 Page 1

ID:DMCubINVR6TstFoe31v6l zng1l-pYYkap1eeGPhnE6LleJ7RUC2j9wh9SMbv7NC zME7y

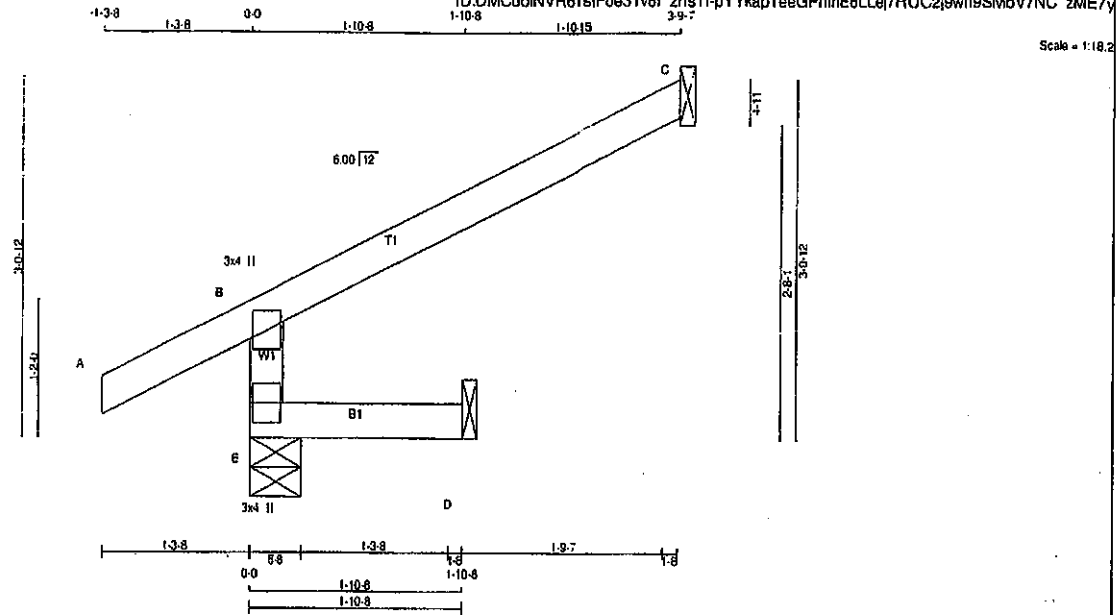

TOTAL WEIGHT = 3 X 10 = 29 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED	MAXIMUM FACTORED	INPUT	REQD	
	GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
E	381	0	381	0	5-8
C	130	0	130	0	1-8
D	18	0	17	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C. D

UNFACTORED REACTIONS						
JT	1ST LOASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD
E	250	190	0	0	0	60
C	90	73	0	0	0	17
D	12	0	0	0	0	12

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED		MEMB.	MAX. FACTORED	FORCE	MAX
	FORCE	VERT. LOAD	LC1 MAX		FORCE	MAX	
	(LBS)	(PLF)	CSI (LC)		(LBS)	CSI (LC)	
FR-TO		FROM TO	UNBRAC	FR-TO			
			LENGTH				
E-B	-342	0	0.0	0.0	0.01 (4)	7.81	
A-B	0	28	-91.8	-91.8	0.13 (5)	10.00	
B-C	-19	0	-91.8	-91.8	0.22 (1)	6.25	
E-D	0	0	-18.5	-18.5	0.02 (4)	10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.22(1.00) (B-C:1), BC=0.02(1.00) (D-E:4), WB=0.00(1.00) (A-B:0), SS=0.15(1.00) (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (E) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007650

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	C43	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:19:46 2020 Page 1
ID:DMCubINVR6TstF0a31v6l_zns1l-lk68o92GPaXYNxp1v39yf11OQ8VqQcIVq9x1RzME7x

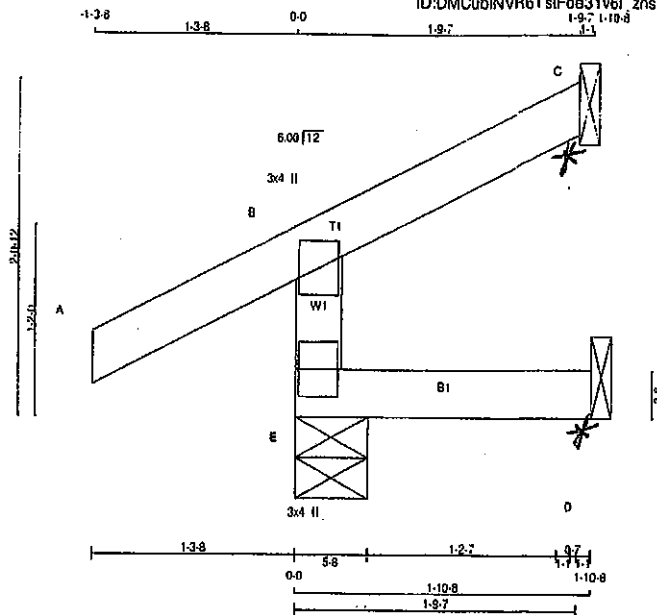

Scale = 1/16"

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2		
A - C	2x4	DRY	No.2		
E - D	2x4	DRY	No.2		

DRY: SEASONED LUMBER.

PLATES (table in inches)	W	LEN	V	X
JT TYPE	PLATES			
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ
E	271	0	271	0
C	45	0	45	0
D	8	0	17	0

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE			
E	188	141	0	0.0	0.0	47
C	31	24	-18	0.0	0.0	7
D	7	0	-8	0.0	0.0	12

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX. FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. (PLF)	CS1 (LC)	UNBRAC	MEMB.	FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO		LENGTH	FR-TO		
E-B	-244	0	0.0	0.0	0.04 (5)	7.81	
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00	
B-C	-17	0	-91.8	-91.8	0.09 (1)	6.25	
E-D	0	0	-18.5	-18.5	0.04 (5)	10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 7 = 21 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.8	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN (LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19')
CALCULATED VERT. DEFL.(LL) = L/999 (0.00')
ALLOWABLE DEFL.(TL) = L/360 (0.19')
CALCULATED VERT. DEFL.(TL) = L/999 (0.00')

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5),
WB=0.00/1.00 (n/a:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618	354	1687
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (E) INPUT = 0.90
JSI METAL = 0.07 (B) INPUT = 1.00

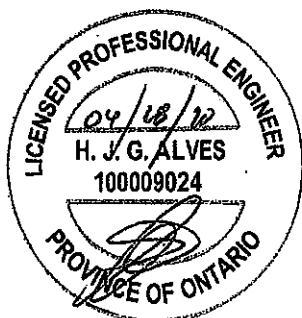

Structural component only
DWG# T-2007651

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C44	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:47 2020 Page 1	

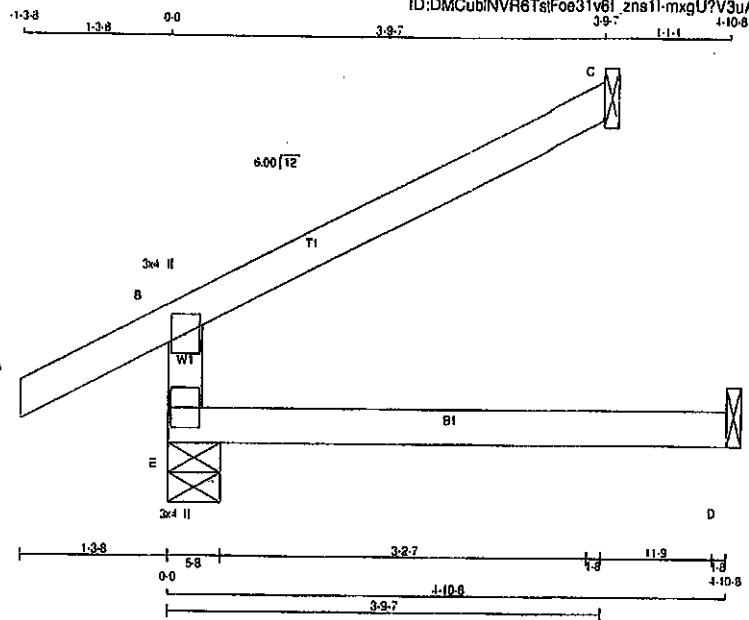

TOTAL WEIGHT = 2 X 13 = 26 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	HORZ	BRG	BRG	BRG	BRG
E	394	0	394	0	0	5-8	5-8		
C	130	0	130	0	0	1-8	1-8		
D	38	0	42	0	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST LCASE		MAX. MIN. COMPONENT REACTIONS		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	DEAD	SOIL	DEAD	SOIL
E	277	190	0	0	0	0	0	87	0	0	0
C	90	73	0	0	0	0	0	17	0	0	0
D	30	0	0	0	0	0	0	30	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	FORCE (LBS)	MAX. CS (LC)	MAX. CS (LC)
FR-TO		FROM	TO	FR-TO			
E-B	-342	0	0.0	0.08 (4)	7.81		
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00	
B-C	-19	0	-91.8	-91.8	0.22 (1)	8.25	
E-D	0	0	-18.5	-18.5	0.09 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BC80 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.22:1.00 (B-C:1), BC=0.09:1.00 (D-E:4), WB=0.09:1.00 (max), SSI=0.15:1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (E) INPUT = 0.90 J
JSI METAL= 0.09 (B) INPUT = 1.00 J

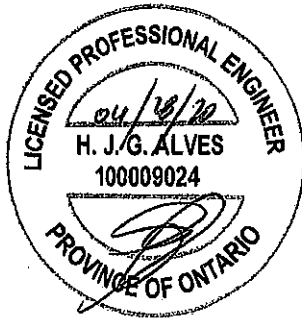


Structural component only
DWG# T-2007652

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	C45	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:48 2020 Page 1

ID:DMCubINVR6TslFoe31v6f_zns11-E7DsC3WxBnFcFyq1UCQ46kwwAMuWGoHTL1pJzME7v

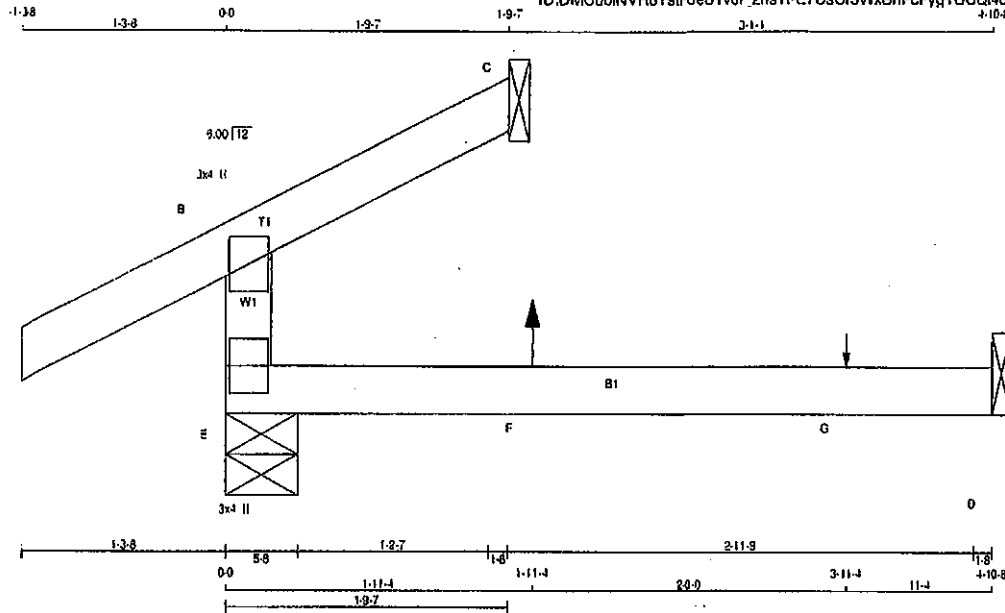

Scale = 1:12

LUMBER

N. L. G. A. RULES				
CHORDS		SIZE		LUMBER
E - B	2x4	DRY		No.2
A - C	2x4	DRY		No.2
E - D	2x4	DRY		No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
E	282	282	0	5-8
C	55	55	0	1-8
D	35	44	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	198	137	0	0	0	61	0
C	39	21	0	0	0	18	0
D	29	0	4	0	0	31	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (7)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORZ. LOAD (LBS)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORZ. LOAD (LBS)	MAX. UNBRACED LENGTH (FT)
E-B	-235	0	0.0	0.07 (4)	7.81				
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00			
B-C	-13	5	-81.8	-81.8	0.07 (5)	6.25			
E-F	0	0	-18.5	-18.5	0.10 (4)	10.00			
F-G	0	0	-18.5	-18.5	0.10 (4)	10.00			
G-D	0	0	-18.5	-18.5	0.10 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	1-11-4	7	1	12	BACK	VERT	TOTAL	---	C1
G	3-11-4	1	1	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.12/1.00 (A-B:1), BC=0.10/1.00 (D-E:4),
WB=0.00/1.00 (A-D:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	816	354	1867

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 6.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007653

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C46	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Tue Apr 26 10:19:49 2020 Page 1
ID:DMCubINVR6TsIFoe31v6l zns1I-iJnEQB48hUv6EPXlaBjHHfuKKVjdzSxW75bLlzME7U

Scale = 1:18.2

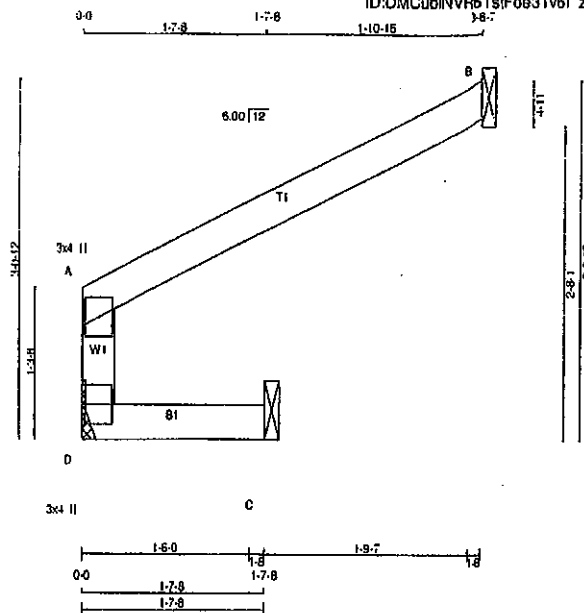

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
D - A	2x4	DRY	No.2	SPF	
A - B	2x4	DRY	No.2	SPF	
D - C	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
D	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
D	156	0	156	0
B	144	0	144	0
C	55	0	55	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1'-8".

SEE MITTEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	109	78	0	0	0	0	31	0
B	99	80	0	0	0	0	19	0
C	46	23	0	0	0	0	17	0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB. FR-TO	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO					
D- A	-181	0.0	0.0	0.08 (1)	7.81			
A- B	-8	-91.8	-91.8	0.14 (1)	10.00			
D- C	0	0	-18.5	-18.5	0.09 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

15% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19')
CALCULATED VERT. DEFL. (LL) = L/999 (0.00')
ALLOWABLE DEFL. (TL) = L/360 (0.19')
CALCULATED VERT. DEFL. (TL) = L/999 (0.00')

CSI: TC=0.14/1.00 (A-B:1), BO=0.09/1.00 (C-D:1),
WB=0.00/1.00 (n/a:0), SS=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.08 (D) (INPUT = 0.90)
JSI METAL = 0.05 (A) (INPUT = 1.00)



Structural component only
DWG# T-2007654


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	C47	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:50 2020 Page 1

ID:DMCubINVR6TslFos31v8l zns11-AWLddX5mSo1zrY638uEuqVB5sks7MQ5knq8uCzME7e

Scale = 1:13.1

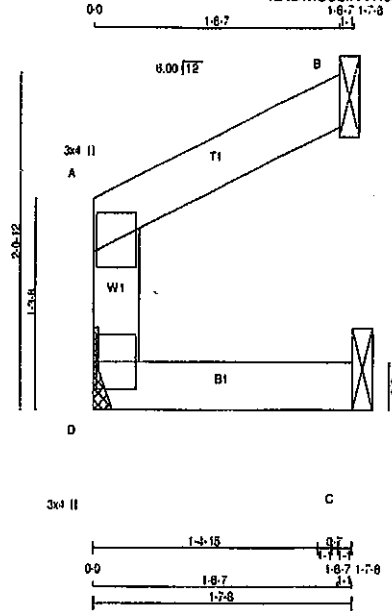

TOTAL WEIGHT = 5 lb (M/F)

LUMBER

N.L.G.A. RULES	CHORDS	SIZE	LUMBER	DESCR.
D - A	2x4	DRY	No.2	SPF
A - B	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
O	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT 8RG	REQD 8RG
D	88 0	88 0	0	0
B	67 0	67 0	1-8	1-8
C	19 0	19 0	1-8	1-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	81	39 0	0 0	0 0	0 0	0 0	21 0	0 0
B	46	37 0	0 0	0 0	0 0	0 0	9 0	0 0
C	14	2 0	0 0	0 0	0 0	0 0	12 0	0 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRACED LENGTH	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
D-A	-74 0	0.0	0.0	0.01 (1)	7.81				
A-B	-2 0	-91.8	-91.8	0.03 (1)	10.00				
D-C	0 0	-18.5	-18.5	0.01 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19')
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19')
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CS1: TC=0.03/1.00 (A-B:1), BC=0.01/1.00 (C-D:4).
WB=0.00/1.00 (n/a:0), SS1=0.05/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.03 (D) INPUT = 0.90
JSI METAL = 0.02 (A) INPUT = 1.00



Structural component only
DWG# T-2007655

LUL/LUS/LJS/HUS/HHUS/HGUS

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of a) easier installation, b) higher capacities, c) lower installed cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.

Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:

- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1 1/4" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:

- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options Information on p. 126.




Double-Shear Nailing Top View




Double-Shear Nailing Side View; Do not bend tab




Dome Double-Shear Nailing Side View (available on some models)
U.S. Patent 5,803,580

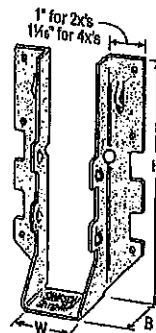


LUS28




LU26L

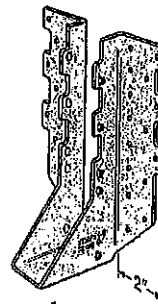


HUS210
(HUS26, HUS28, and HHUS similar)



HGUS28-2




HHUS210-2



LJS26DS

Typical HUS26 Installation with Reduced Heel Height (Truss Designer to provide fastener quantity for connecting multiple members together)

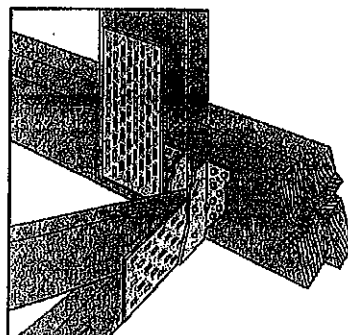

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options Information on pp. 125-127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
$W < 2"$	Bevel or square cut	0.62 of table value	0.46 of table value
$2" < W < 6"$	Bevel cut	0.67 of table value	0.41 of table value
$2" < W < 6"$	Square cut	0.46 of table value	0.41 of table value
$W > 6"$	Bevel cut	0.75 of table value	0.41 of table value

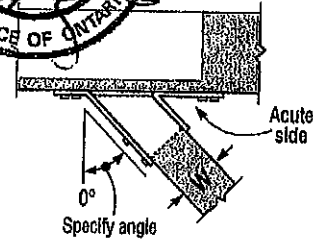

Top View HHUS Hanger Skewed Right
(Joist must be bevel cut)
All joist nails installed on the outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _g ³	Header	Joist	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN	(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN
Single 2x Sizes											
LUS24	18	1 1/8	3 1/4	1 1/4	2 1/4	(4) 10d	(2) 10d	710 316	1625 723	645 287	1155 514
LU24L	22	1 1/8	3	1 1/4	2 1/8	(4) 10d	(2) 10d x 1 1/2"	360 160	1020 454	320 142	725 322
LU26L	22	1 1/8	5	1 1/4	4 1/4	(6) 10d	(4) 10d x 1 1/2"	720 320	1605 714	645 287	1140 507
LUS26	18	1 1/8	4 1/4	1 1/4	3 3/4	(4) 10d	(4) 10d	1420 632	2170 965	1290 574	1630 725
HUS26	16	1 1/8	5 1/4	3	3 1/8	(14) 16d	(8) 16d	2705 1130	4940 2197	2065 920	3875 1724
LJS26DS	18	1 1/8	5	3 1/4	4 1/4	(16) 16d	(8) 16d	2055 914	4265 1897	1480 648	4115 1831
HGUS26	12	1 1/8	5 1/4	5	4 1/4	(20) 16d	(8) 16d	2685 1196	6625 2951	2685 1198	5700 2535
LU28L	20	1 1/8	6 1/4	1 1/4	5 1/4	(8) 10d	(6) 10d x 1 1/2"	1140 507	2185 972	1020 454	1550 689
LUS28	18	1 1/8	6 1/4	1 1/4	3 3/4	(6) 10d	(4) 10d	1420 632	2520 1121	1290 574	1790 796
HUS28	16	1 1/8	7 1/4	3	6 1/8	(22) 18d	(8) 18d	3605 1604	5365 2388	2675 1190	4345 1933
HGUS28	12	1 1/8	7 1/4	5	8 1/8	(36) 18d	(12) 18d	3310 1474	7675 3419	3310 1474	6900 3073
LU210L	20	1 1/8	8	1 1/4	7 1/4	(10) 10d	(8) 10d x 1 1/2"	1140 507	2495 1110	1020 454	1770 787
LUS210	18	1 1/8	7 1/4	1 1/4	3 3/4	(8) 10d	(4) 10d	1420 632	2785 1239	1290 574	2210 983

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_g is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27-28 for other nail sizes and information.

Face-Mount Hangers


SIMPSON

Strong-Tie

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _o ³	Header	Joist	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)
								lb.	lb.	lb.	lb.
								kN	kN	kN	kN
Double 2x Sizes											
LUS24-2	18	3 1/8	3 1/8	2	1 1/4	(4) 16d	(2) 16d	835	2020	590	1435
SS LUS26-2	18	3 1/8	4 1/8	2	4	(4) 16d	(4) 16d	3.71	8.99	2.62	6.38
								1720	2505	1545	1920
								7.65	11.54	6.87	8.54
HHUS26-2	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	2850	7335	2065	5205
								12.68	32.83	9.20	23.15
HGUS26-2	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
SS LUS28-2	18	3 1/8	7	2	4	(8) 16d	(4) 16d	1720	3325	1545	2575
								7.65	14.79	6.87	11.45
HHUS28-2	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3765	8940	2675	6345
								16.75	39.77	11.90	28.22
HGUS28-2	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
SS LUS210-2	18	3 1/8	9	2	6	(8) 16d	(8) 16d	2580	4500	2320	3195
								11.48	20.02	10.32	14.21
HHUS210-2	14	3 1/8	9 1/8	3	8	(30) 16d	(10) 16d	4670	9660	4235	7000
								20.77	42.97	18.84	31.14
HGUS210-2	12	3 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	6840	14015	4855	10270
								30.43	62.34	21.60	45.69
Triple 2x Sizes											
HGUS26-3	12	4 1/8	5 1/2	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-3	12	4 1/8	7 1/4	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d	4670	9670	4235	6865
								20.77	43.02	18.84	30.54
HGUS210-3	12	4 1/8	9 1/4	4	8 1/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.28
Quadruple 2x Sizes											
HGUS26-4	12	6 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-4	12	6 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-4	14	6 1/8	8 1/8	3	7 1/8	(30) 16d	(10) 16d	4670	10155	4235	7210
								20.77	45.17	18.84	32.07
HGUS210-4	12	6 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	6840	14045	4855	10400
								30.43	65.14	21.60	46.26
HGUS212-4	12	6 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	7640	14995	5425	10645
								33.98	66.70	24.13	47.35
HGUS214-4	12	6 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.08	72.95	32.00	51.80
4x Sizes											
LUS46	18	3 1/8	4 1/8	2	3 1/8	(4) 16d	(4) 16d	1720	2505	1545	1920
								7.65	11.54	6.87	8.54
HHUS46	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	2540	7335	2065	5205
								11.30	32.83	9.20	23.15
HGUS46	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
LUS48	18	3 1/8	6 1/8	2	3 1/8	(8) 16d	(4) 16d	1720	3325	1545	2575
								7.65	14.79	6.87	11.45
HHUS48	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3765	8940	2675	6345
								16.75	39.77	11.90	28.22
HGUS48	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
LUS410	18	3 1/8	8 1/8	2	5 1/8	(8) 16d	(6) 16d	2580	4500	2320	3195
								11.48	20.02	10.32	14.21
HGUS410	12	3 1/8	9	4	8 1/8	(46) 16d	(16) 16d	6840	14015	4855	10270
								30.43	62.34	21.60	45.69
HGUS412	12	3 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	7640	14995	5425	10845
								33.98	66.70	24.13	47.35
HGUS414	12	3 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.08	72.95	32.00	51.80



Plated Truss Connectors

See footnotes on p. 258.

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1 1/4". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

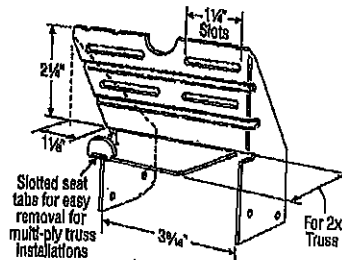


TC24
U.S. Patent 4,932,173

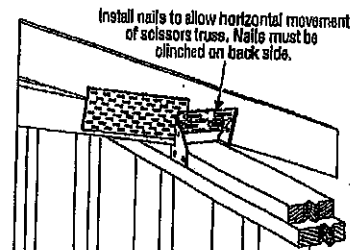


Typical TC24 Installation

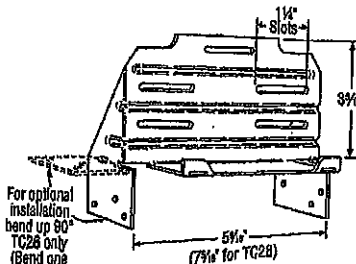

TC26
(TC28 Similar)

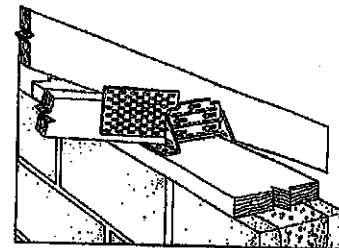

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer (8", 10", 12" Wall Installation Similar)

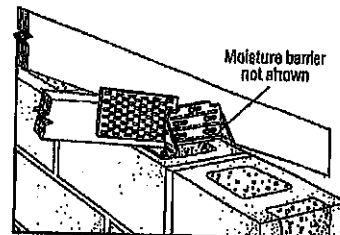

Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _o =1.15)	Uplift (K _o =1.15)
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(6) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _o =1.15)	Uplift (K _o =1.15)
TC26	(5) 10d	(6) 10d x 1 1/2"	810	660
	(5) 10d	(6) 10d	930	660

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.
2. Grout strength is 15 MPa minimum.
3. Optional TC26 installation with 10d nails requires minimum 3" top plate thickness.
4. TC26 fastened to grouted concrete block with (8) - 9/16" x 2 1/4" Titen screws has a factored uplift resistance of 276 lb.



UNITED STATES DESIGN

© 2017 Simpson Strong-Tie Company, Inc.
All rights reserved. Simpson Strong-Tie, the Simpson Strong-Tie logo, and the Strong-Tie logo are registered trademarks of Simpson Strong-Tie Company, Inc. in the United States and other countries.

(800) 999-5099
strongtie.com

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_D = 1.15$)					
					D.Fir-L			S-P-F		
		To Rafters/Truss	To Plates	To Studs	Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(5) 8d x 1½"	(4) 8d	—	740	685	300	680	485	215
					3.29	3.05	1.33	3.02	2.16	0.98
SS H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
					3.68	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	160	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	205	615	125	190
					3.29	0.80	1.18	2.74	0.66	0.86
H6	16	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	870	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS H8*	18	(5) 10d x 1½"	(5) 10d x 1½"	—	1120	—	—	1025	—	—
					4.98	—	—	4.56	—	—
SS H10A*	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	585	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.54	1.36
H10A-2	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1835	1275	430	1645	880	305
					8.16	5.67	1.91	7.32	3.91	1.36
H10S ^{2d}	18	(8) 8d x 1½"	(8) 8d x 1½"	(8) 8d	1465	795	315	1040	585	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2½"	(6) 16d x 2½"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.81	1.73
H14	18	[1] (12) 8d x 1½"	(13) 8d	—	2390	855	320	1805	610	230
		[2] (12) 8d x 1½"	(15) 8d	—	10.63	3.80	1.42	8.03	2.71	1.02
					2390	855	320	1805	610	230
TSP	16	(9) 10d x 1½"	(6) 10d x 1½"	—	10.63	3.80	1.42	8.03	2.71	1.02
					1295	440	—	920	310	—
		(9) 10d x 1½"	(6) 10d	—	5.76	1.96	—	4.09	1.38	—
					1580	440	—	1105	310	—
					6.94	1.96	—	4.92	1.38	—

- Factored resistances have been increased 15% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 595 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-H(TIE)CONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 6/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1½" nails into the top plates and (3) 8d x 1½" nails into the lowest three flange holes into the truss bottom chord is 495 lb. (2.20 kN).
- Nails: 16d x 2½" = 0.162" dia. x 2½" long, 10d = 0.148" dia. x 3" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long, 8d x 1½" = 0.131" dia. x 1½" long. See pp. 27-28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry ($< 19\%$ moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

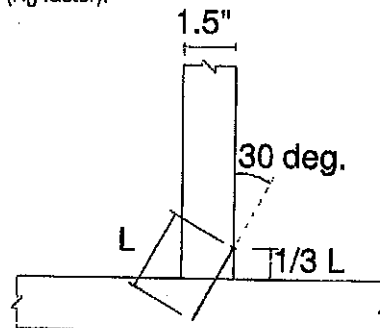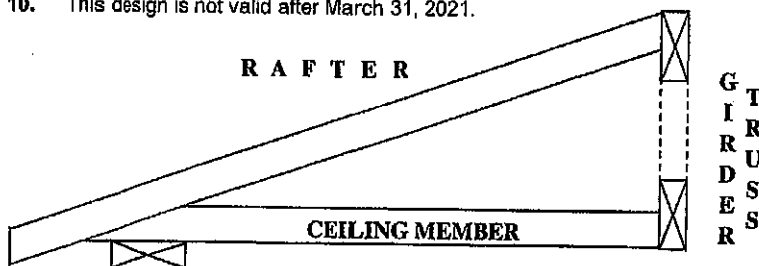

TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (In)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek

MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to wind or earthquake load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

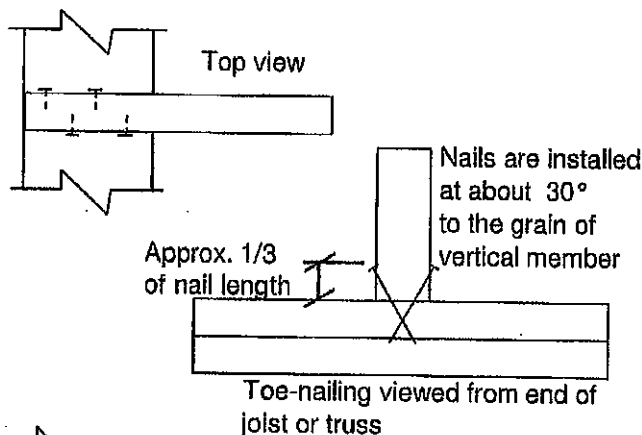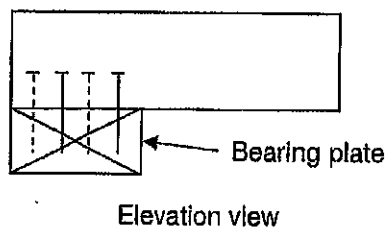

Toe-nailing on 2x4 Bearing Plate

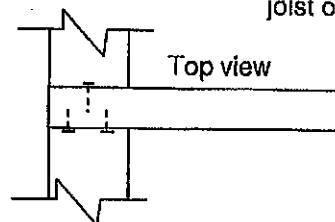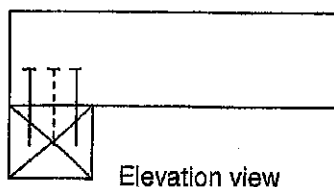


MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7




December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint, unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/8" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

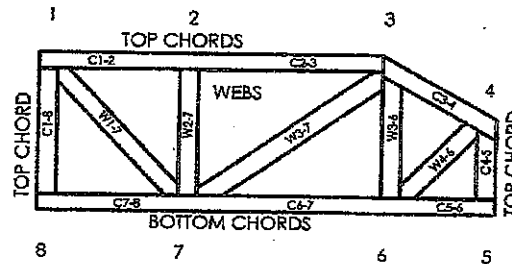

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MIT
MiTek

POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MIT-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane of joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.


Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

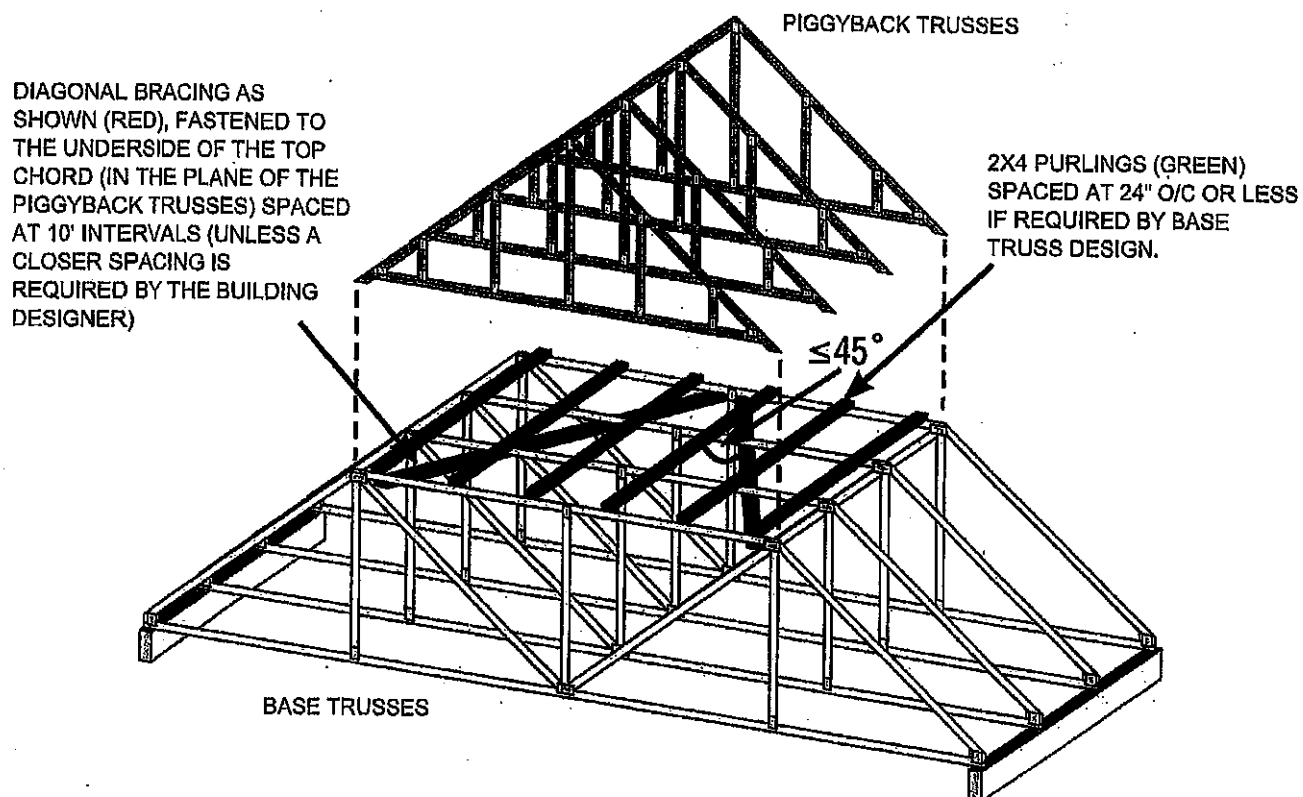

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8- Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1900213

Feb 09, 2018