


6/12 roof pitch unless noted

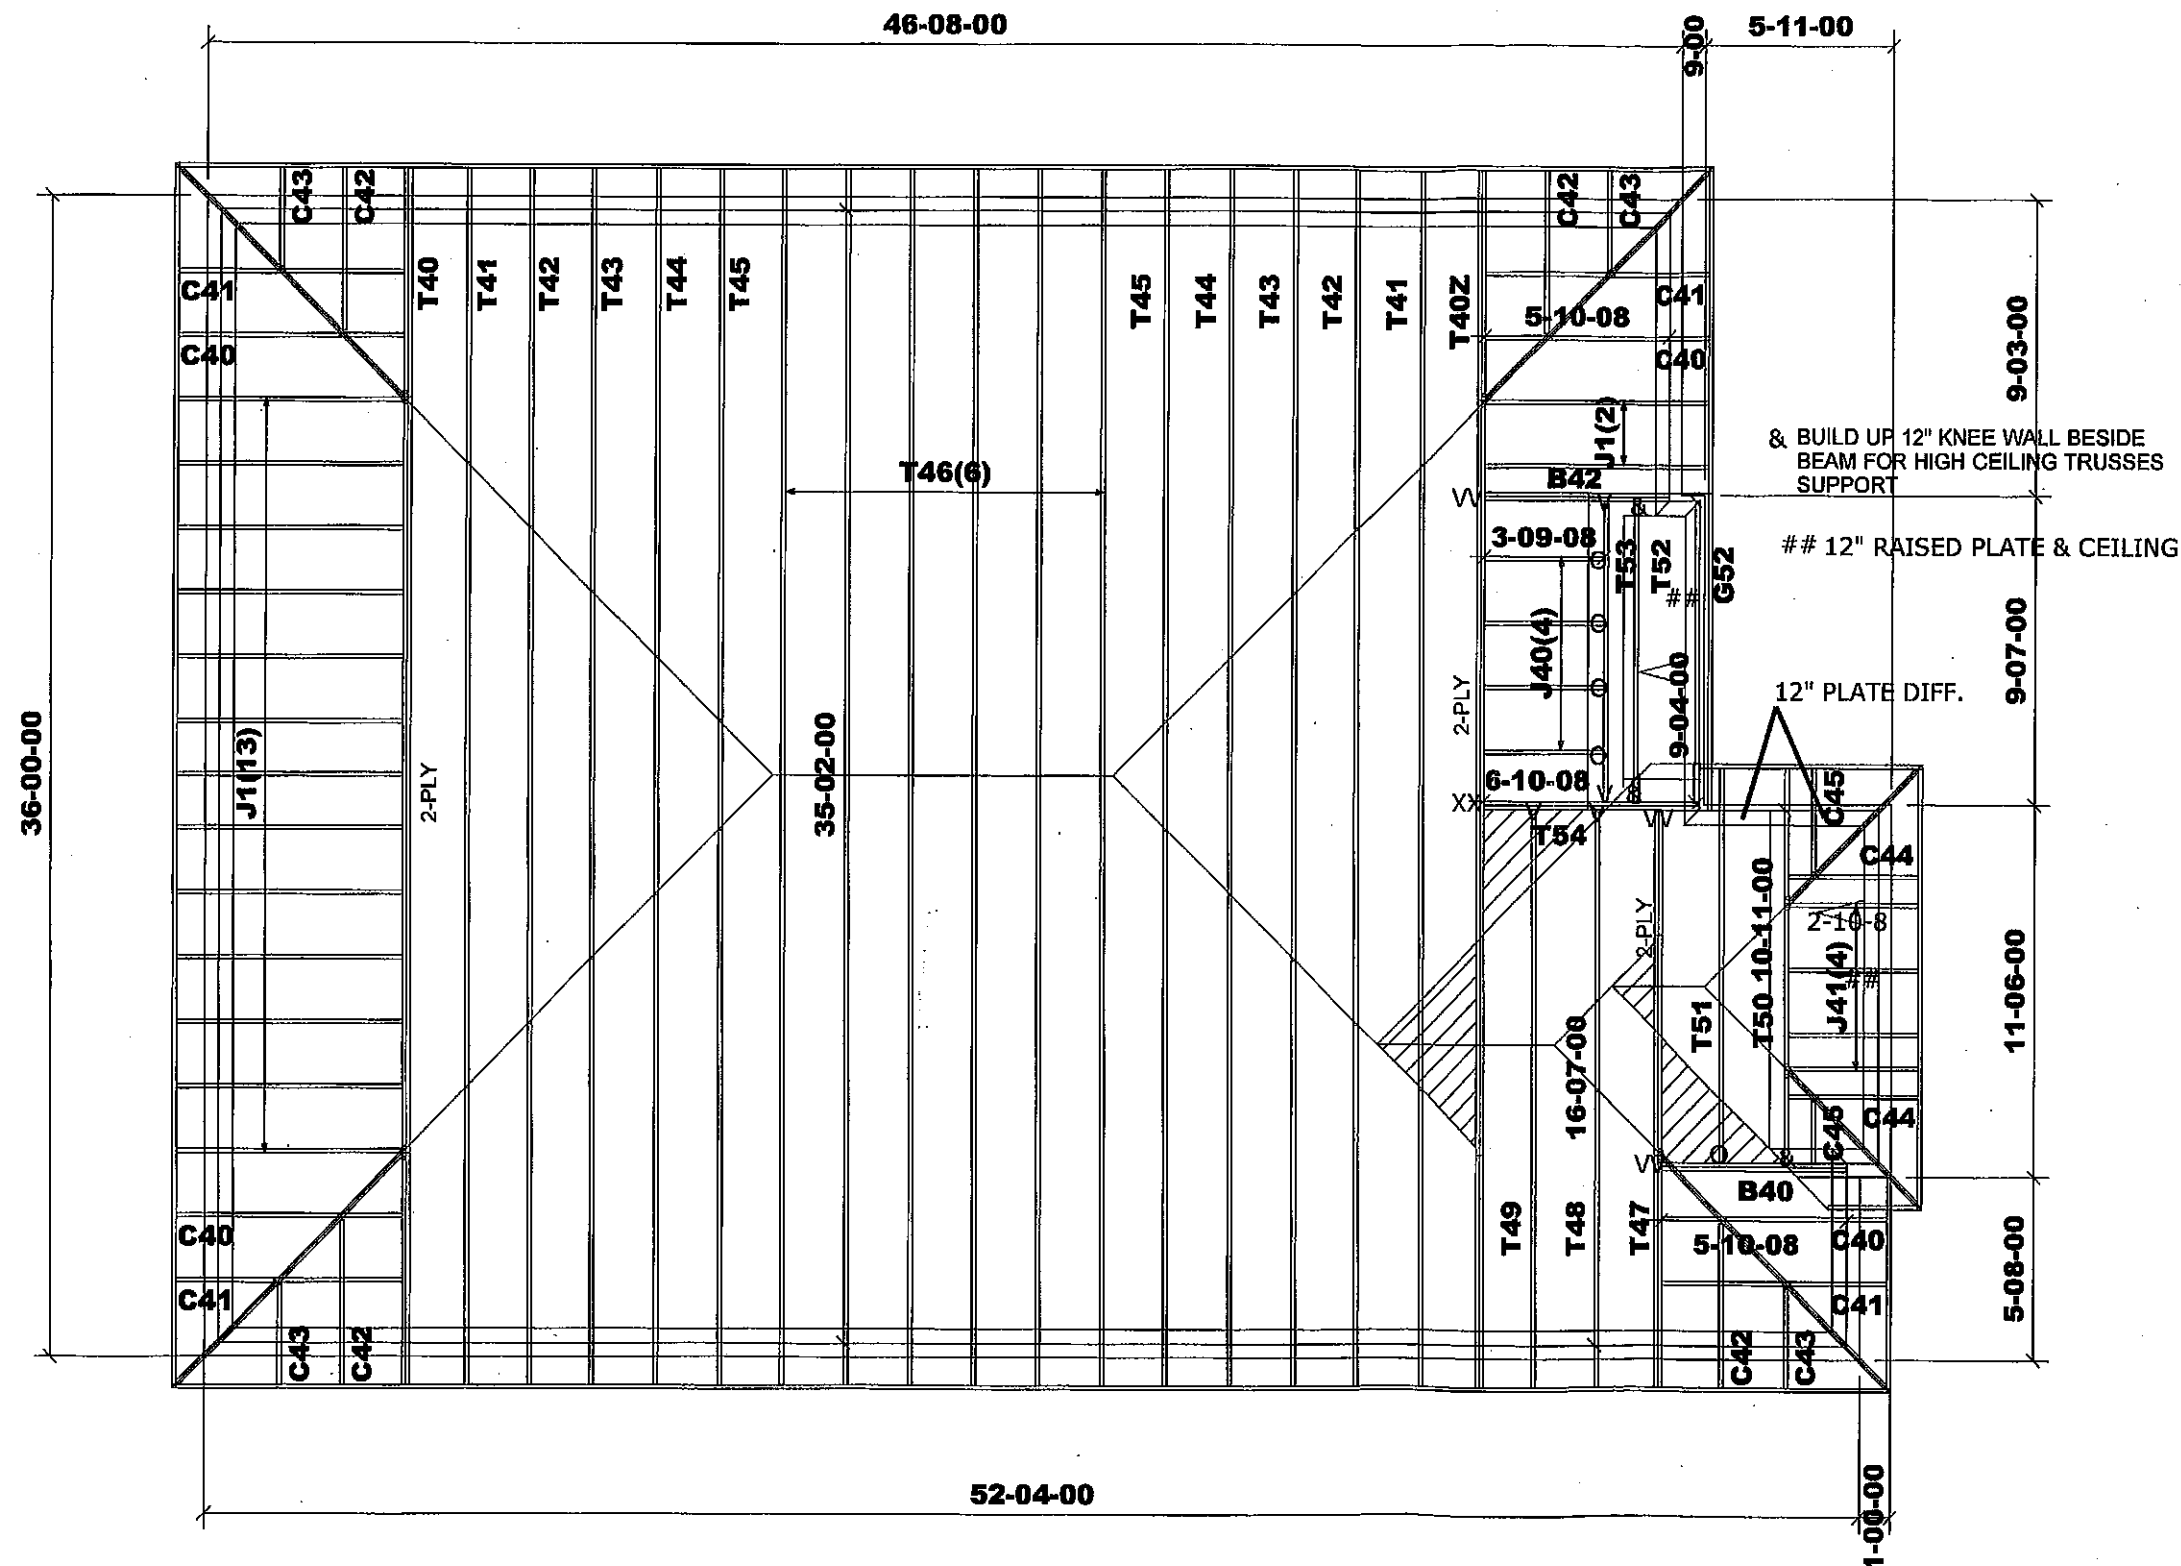

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.


All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: .
RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)
LUS26-2-(VV)

BEAMS:
B40= B41 = B42=
2 - 2x10 SPF #2

 DENOTES:
CONVENTIONAL
FRAMING

CITY OF HAMILTON BUILDING DIVISION Planning & Development Department	
FEB 10 2021	
REC'D BY	DATE
REF'D TO	DATE

M13125



Job Track: **51225**
Plan Log: **202401**
Layout ID: **408152**

Builder / Location:
GREEN PARK HOMES / WATERDOWN
Project: **RUSSELL GARDENS PH.3**
Date: 2020-04-27 Sales: **Mario DiCano** Designer: **JG**

Model / Elevation:
MOUNTAINASH 4/3- std. or opt.

LOT 338

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

DELIVERY SHIPLIST




Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 4
 Lot #: 338
 Elevation: 3- std. or opt.

Job Track: 51225
 PlanLog: 202401
 Layout ID: 408152
 Ref #
 Page: 1 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T40 Hip Girder	6 /12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	340.74 212.00		
	1 2-ply	T40Z Hip Girder	6 /12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	340.74 212.00		
	2	T41 Hip	6 /12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.99 174.00		
	2	T42 Hip	6 /12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.12 174.67		
	2	T43 Hip	6 /12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	289.07 179.67		
	2	T44 Hip	6 /12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	290.73 183.33		
	2	T45 Hip	6 /12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	301.87 191.33		
	6	T46 Common	6 /12	35-02-00	9-11-08	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	910.08 558.00		
	1 2-ply	T47 Hip Girder	6 /12	16-07-00	4-01-04	2 x 4 2 x 6	1-03-08	1-02-00 2-02-00	158.02 100.67		
	1	T48 Hip	6 /12	16-07-00	5-01-04	2 x 4	1-03-08	1-02-00 2-02-00	68.15 43.33		
	1	T49 Common	6 /12	16-07-00	5-09-12	2 x 4	1-03-08	1-02-00 2-02-00	67.14 42.33		
	1	T50 Hip Girder	6 /12	10-11-00	2-07-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	42.73 28.33		
	1	T61 Hip	6 /12	10-11-00	4-07-04	2 x 4	1-03-08 1-03-08	2-02-00 2-02-00	51.54 34.50		
	1	T52 Flat	0 /12	9-04-00	2-10-00	2 x 4		2-10-00 2-10-00	36.11 23.83		

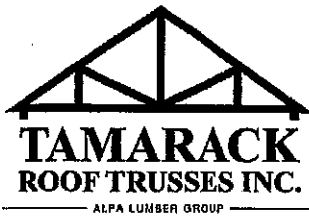

DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 4
 Lot #: 338
 Elevation: 3- std. or opt.

Job Track: 51225
 PlanLog: 202401
 Layout ID: 408152
 Ref #
 Page: 2 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	G52 GABLE	0 /12	9-04-00	2-10-00	2 x 4		2-10-00 2-10-00	33.75 23.33		
	1	T53 Flat Girder	0 /12	9-04-00	3-10-00	2 x 6		3-10-00 3-10-00	50.9 31.50		
	1 2-ply	T54 Jack-Closed Girder	6 /12	6-10-08	4-01-04	2 x 4 2 x 6		8-00 4-01-04	59.61 37.33		
	15	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	251.92 160.00		
	4	J40 Jack-Open	6 /12	3-09-08	4-01-04	2 x 4		2-02-08 4-01-04	52.34 35.33		
	4	J41 Jack-Open	6 /12	2-10-08	2-07-04	2 x 4	1-03-08	1-02-00 2-07-04	38.2 24.00		
	4	C40 Jack-Open	6 /12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	56.53 34.67		
	4	C41 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	46.33 29.33		
	4	C42 Jack-Open	6 /12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	38.28 24.00		
	4	C43 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	28.08 18.67		
	2	C44 Jack-Open	6 /12	1-10-15	2-01-08	2 x 4	1-03-08 11-09	1-02-00 2-01-08	16.64 10.67		
	2	C45 Jack-Open	6 /12	1-10-15	2-01-08	2 x 4	1-03-08 1-01	1-02-00 2-01-08	14.85 9.33		

TOTAL # TRUSS= 74

TOTAL BFT OF ALL TRUSSES= 2596.15

BFT.

TOTAL WEIGHT OF ALL TRSSES 4137.05 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	HGUS26-2	
4	Hardware	LJS26DS	

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
Builder: GREEN PARK HOMES
Project: RUSSELL GARDENS PH.3
Location: WATERDOWN
Model: MOUNTAINASH 4
Lot #: 338
Elevation: 3- std. or opt.

Job Track: 51225
PlanLog: 202401
Layout ID: 408152
Ref #
Page: 3 of 3
Date: 04-27-2020
Designer:
Sales Rep: Mario DiCano

HARDWARE

QTY	TYPE	MODEL	LENGTH
5	Hardware	LUS24	
3	Hardware	LUS26-2	


TOTAL NUMBER OF
ITEMS=

13

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408150	T1	1	2	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 11:02:47 2020 Page 1
ID:7vF7aG0E03cRU6X1JSkziWYK-VShX5DRAXNE15LAM_IsZu8zCRhp/kACNpVGMzNCnc

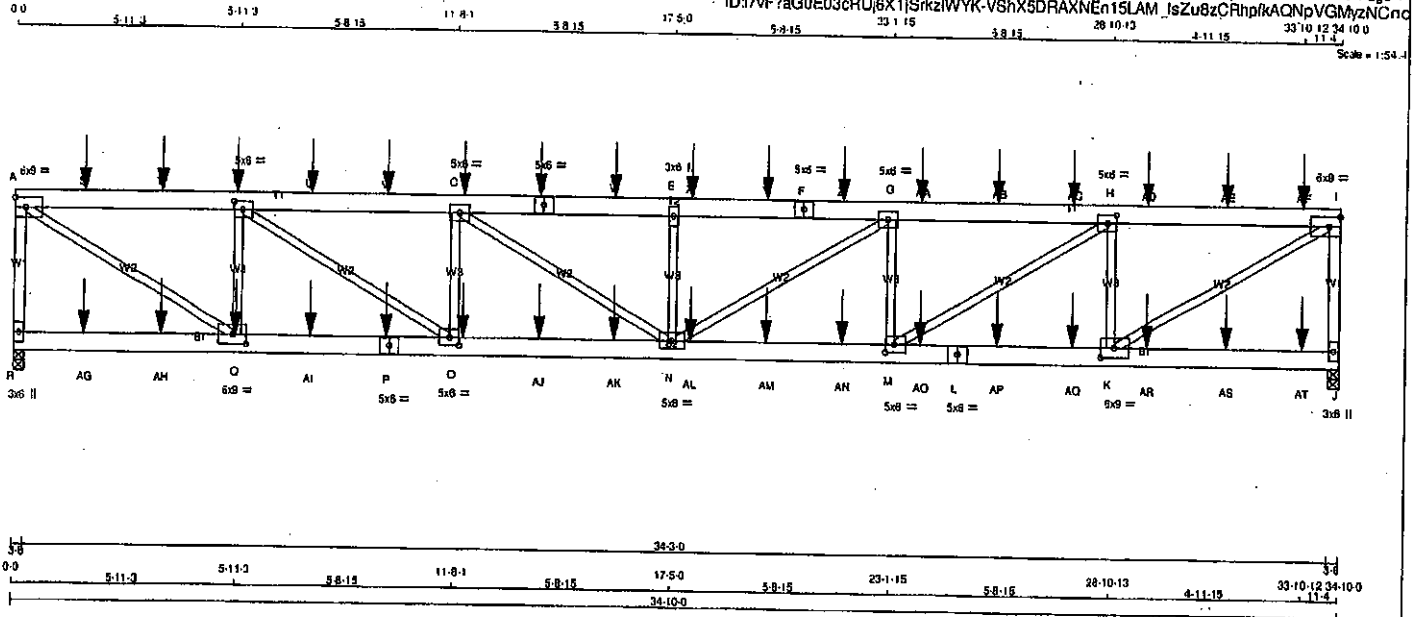

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DRY
R - A	2x4	DRY	No.2
A - D	2x6	DRY	No.2
D - F	2x6	DRY	No.2
F - I	2x6	DRY	No.2
J - L	2x4	DRY	No.2
R - P	2x6	DRY	No.2
P - L	2x6	DRY	No.2
L - J	2x6	DRY	No.2

ALL WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
R - A 1	12	TOP
I - J 1	12	TOP
A - D 2	12	SIDE(183.1)
D - F 2	12	SIDE(0.0)
F - I 2	12	SIDE(0.0)
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
R - P 2	12	SIDE(183.1)
P - L 2	12	SIDE(183.1)
L - J 2	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL. APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	GROSS REACTION	JT	GROSS REACTION	JT	GROSS REACTION	JT	GROSS REACTION	JT	GROSS REACTION
R	3052	0	3052	0	3052	0	3052	0	3052
J	3118	0	3118	0	3118	0	3118	0	3118

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. (LBS)	MEMB.	FORCE (LBS)	MAX. (LBS)	MAX. (LBS)
FR-TO				FR-TO			
R-A	-2874 / 0	0.0	0.0	0.34 (1)	0.68	0.63 (1)	0.63 (1)
A-S	-4326 / 0	-91.8	-91.8	0.20 (1)	5.32	0.75078	0.63 (1)
S-T	-4326 / 0	-91.8	-91.8	0.20 (1)	5.32	0.75078	0.30 (1)
T-B	-4326 / 0	-91.8	-91.8	0.20 (1)	5.32	0.75078	0.29 (1)
B-U	-8696 / 0	-91.8	-91.8	0.25 (1)	4.43	0.72804	0.35 (1)
U-V	-8696 / 0	-91.8	-91.8	0.25 (1)	4.43	0.72804	0.35 (1)
V-C	-8696 / 0	-91.8	-91.8	0.25 (1)	4.43	0.72804	0.16 (1)
C-D	-7505 / 0	-91.8	-91.8	0.23 (1)	4.25	0.71268	0.16 (1)
D-W	-7505 / 0	-91.8	-91.8	0.23 (1)	4.25	0.71268	0.12 (1)
W-E	-7505 / 0	-91.8	-91.8	0.23 (1)	4.25	0.71268	0.12 (1)
E-X	-7505 / 0	-91.8	-91.8	0.23 (1)	4.25	0.71268	0.10 (1)
X-Y	-7505 / 0	-91.8	-91.8	0.23 (1)	4.25	0.71268	0.10 (1)
Y-F	-7505 / 0	-91.8	-91.8	0.23 (1)	4.25	0.71268	0.10 (1)
F-Z	-7505 / 0	-91.8	-91.8	0.23 (1)	4.25	0.71268	0.10 (1)
Z-G	-7505 / 0	-91.8	-91.8	0.23 (1)	4.25	0.71268	0.10 (1)
G-AA	-8696 / 0	-91.8	-91.8	0.26 (1)	4.42	0.72804	0.10 (1)
AA-AB	-8696 / 0	-91.8	-91.8	0.26 (1)	4.42	0.72804	0.10 (1)
AB-AC	-8696 / 0	-91.8	-91.8	0.26 (1)	4.42	0.72804	0.10 (1)
AC-H	-8696 / 0	-91.8	-91.8	0.26 (1)	4.42	0.72804	0.10 (1)
H-AD	-4330 / 0	-91.8	-91.8	0.21 (1)	5.30	0.71268	0.10 (1)
AD-AE	-4330 / 0	-91.8	-91.8	0.21 (1)	5.30	0.71268	0.10 (1)
AE-AF	-4330 / 0	-91.8	-91.8	0.21 (1)	5.30	0.71268	0.10 (1)
AF-I	-4330 / 0	-91.8	-91.8	0.21 (1)	5.30	0.71268	0.10 (1)
I-J	-3028 / 0	0.0	0.0	0.35 (1)	0.64	0.63 (1)	0.64

R-AG	0 / 0	-18.5	-18.5	0.08 (4)	10.00
AG-AH	0 / 0	-18.5	-18.5	0.08 (4)	10.00
AH-Q	0 / 0	-18.5	-18.5	0.08 (4)	10.00
Q-AI	0 / 4326	-18.5	-18.5	0.33 (1)	10.00
AI-P	0 / 4326	-18.5	-18.5	0.33 (1)	10.00
P-O	0 / 4326	-18.5	-18.5	0.33 (1)	10.00
O-AJ	0 / 6696	-18.5	-18.5	0.49 (1)	10.00
AJ-AK	0 / 6696	-18.5	-18.5	0.49 (1)	10.00
AK-N	0 / 6696	-18.5	-18.5	0.49 (1)	10.00
N-AL	0 / 6696	-18.5	-18.5	0.49 (1)	10.00
AL-AM	0 / 6696	-18.5	-18.5	0.49 (1)	10.00
AM-AN	0 / 6696	-18.5	-18.5	0.49 (1)	10.00
AN-M	0 / 6696	-18.5	-18.5	0.49 (1)	10.00
MAO	0 / 4330	-18.5	-18.5	0.33 (1)	10.00
AO-L	0 / 4330	-18.5	-18.5	0.33 (1)	10.00
L-AP	0 / 4330	-18.5	-18.5	0.33 (1)	10.00
AP-AQ	0 / 4330	-18.5	-18.5	0.33 (1)	10.00
AQ-K	0 / 4330	-18.5	-18.5	0.33 (1)	10.00

TOTAL WEIGHT = 2 X 178 = 353 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.20")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.38")

CSI: TC=0.35/1.00 (I-J:1), BC=0.49/1.00 (M-N:1),
WB=0.83/1.00 (H-K:1), SS=0.17/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLF) (PLF)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 768 1887 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.66 (K) (INPUT = 0.90)
JSI METAL=0.42 (P) (INPUT = 1.00)

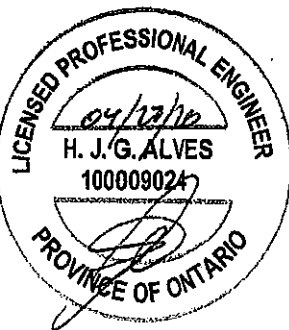

Structural component only
DWG# T-2007063 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408150	T1	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
TRUSS DESC.					

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 11:02:47 2020 Page 2
 ID:7vF7aG0E03cRU6X1ISkzWYK-VShXSDRAXNen15LAM 1sZuBzCRhplKAGNpVGMyzNCnd

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	6.0	9.0		Edge
B	TMVW-t	MT20	5.0	6.0	2.50	2.75
C	TMVW-t	MT20	5.0	6.0		
D	TS-t	MT20	5.0	6.0		
E	TMVW-t	MT20	3.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMVW-t	MT20	5.0	6.0		
H	TMVW-t	MT20	5.0	6.0	2.50	2.75
I	TMVW-t	MT20	6.0	9.0		Edge
J	BMV1-p	MT20	3.0	6.0		
K	BMVW-t	MT20	6.0	9.0	3.00	4.25
L	BS-t	MT20	5.0	6.0		
M	BMVW-t	MT20	5.0	6.0	2.50	2.75
N	BMVW-t	MT20	5.0	6.0		
O	BMVW-t	MT20	5.0	6.0	2.50	2.75
P	BS-t	MT20	5.0	6.0		
Q	BMVW-t	MT20	6.0	9.0	3.00	4.25
R	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LG1 (LC)	MAX. UNBRAC LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)
K-AR	0/0	FROM	TO				
AR-AS	0/0	-18.5	-18.5	0.08 (4)	10.00		
AS-AT	0/0	-18.5	-18.5	0.08 (4)	10.00		
AT-J	0/0	-18.5	-18.5	0.08 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
B	5-10-12	-110	-110		FRONT	VERT	TOTAL		C1
C	11-10-12	-110	-110		FRONT	VERT	TOTAL		C1
D	13-10-12	-110	-110		FRONT	VERT	TOTAL		C1
O	11-10-12	-26	-26		FRONT	VERT	TOTAL		C1
P	9-10-12	-28	-28		FRONT	VERT	TOTAL		C1
Q	5-10-12	-28	-28		FRONT	VERT	TOTAL		C1
S	1-10-12	-110	-110		FRONT	VERT	TOTAL		C1
T	3-10-12	-110	-110		FRONT	VERT	TOTAL		C1
U	7-10-12	-110	-110		FRONT	VERT	TOTAL		C1
V	9-10-12	-110	-110		FRONT	VERT	TOTAL		C1
W	15-10-12	-110	-110		FRONT	VERT	TOTAL		C1
X	17-10-12	-110	-110		FRONT	VERT	TOTAL		C1
Y	19-10-12	-110	-110		FRONT	VERT	TOTAL		C1
Z	21-10-12	-110	-110		FRONT	VERT	TOTAL		C1
AA	23-10-12	-110	-110		FRONT	VERT	TOTAL		C1
AB	25-10-12	-110	-110		FRONT	VERT	TOTAL		C1
AC	27-10-12	-110	-110		FRONT	VERT	TOTAL		C1
AD	29-10-12	-110	-110		FRONT	VERT	TOTAL		C1
AE	31-10-12	-110	-110		FRONT	VERT	TOTAL		C1
AF	33-10-12	-113	-113		FRONT	VERT	TOTAL		C1
AG	1-10-12	-28	-28		FRONT	VERT	TOTAL		C1
AH	3-10-12	-28	-28		FRONT	VERT	TOTAL		C1
AI	7-10-12	-28	-28		FRONT	VERT	TOTAL		C1
AJ	13-10-12	-28	-28		FRONT	VERT	TOTAL		C1
AK	15-10-12	-28	-28		FRONT	VERT	TOTAL		C1
AL	17-10-12	-28	-28		FRONT	VERT	TOTAL		C1
AM	19-10-12	-28	-28		FRONT	VERT	TOTAL		C1
AN	21-10-12	-28	-28		FRONT	VERT	TOTAL		C1
AO	23-10-12	-28	-28		FRONT	VERT	TOTAL		C1
AP	25-10-12	-28	-28		FRONT	VERT	TOTAL		C1
AQ	27-10-12	-28	-28		FRONT	VERT	TOTAL		C1
AR	29-10-12	-28	-28		FRONT	VERT	TOTAL		C1
AS	31-10-12	-28	-28		FRONT	VERT	TOTAL		C1
AT	33-10-12	-27	-27		FRONT	VERT	TOTAL		C1

CONNECTION REQUIREMENTS


1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
 DWG# T-2007063 7/2

Tamarack Roof Truss, Burlington

ID: 47Vf?aG0E03cRUj6X1SkziWYK-zfWlZSolhMafWnWgG566h7Ury008GacTeqvOzNcNb

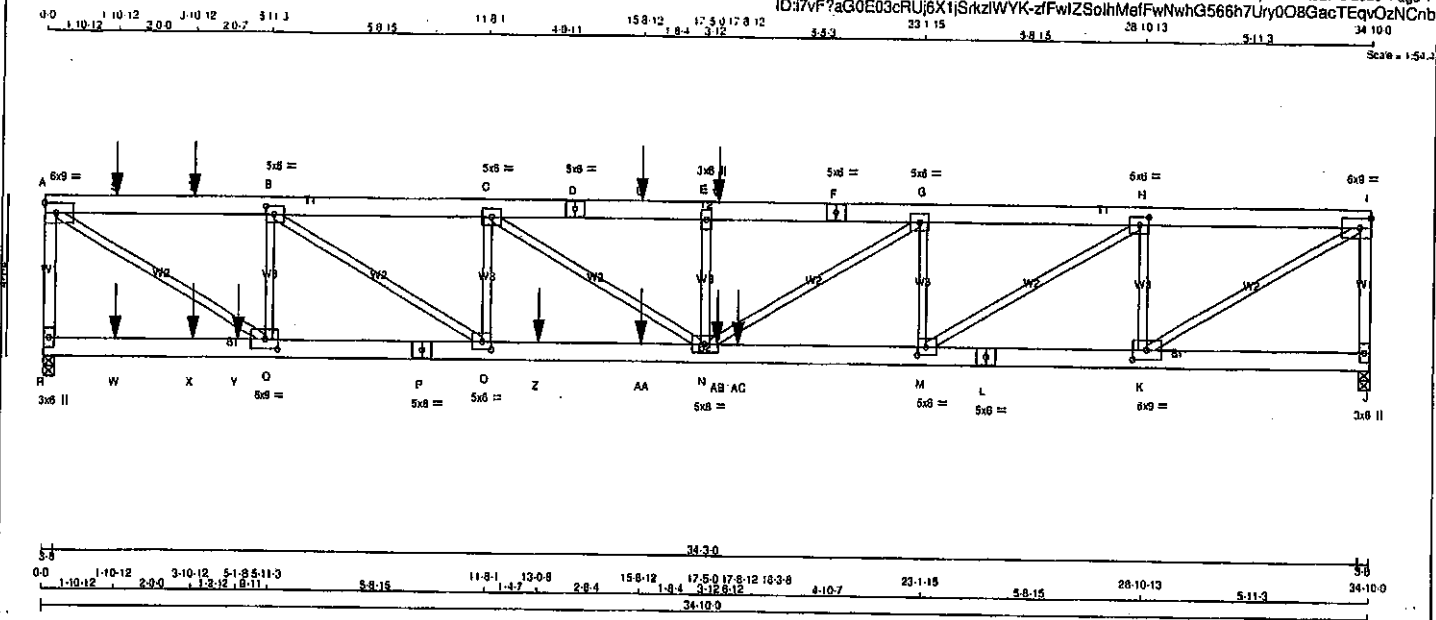

CHORDS	SIZE	DRY	LUMBER	DESCR.
R - A	2x4	DRY	No.2	SPF
A - D	2x6	DRY	No.2	SPF
D - F	2x6	DRY	No.2	SPF
F - I	2x6	DRY	No.2	SPF
J - I	2x4	DRY	No.2	SPF
R - P	2x6	DRY	No.2	SPF
P - L	2x6	DRY	No.2	SPF
L - J	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
R-A	12	TOP
I-J	12	TOP
A-D	12	SIDE(0.0)
D-F	12	SIDE(183.1)
F-I	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
R-P	12	SIDE(0.0)
P-L	12	SIDE(183.1)
L-J	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-8 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	IN-SX	IN-SX
R	4002	0	0	3-8
J	3132	0	0	3-8

UNFACTORED REACTIONS	1ST LOASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
R	2824	1886 / 0 0 / 0 0 / 0 935 / 0 0 / 0
J	2212	1470 / 0 0 / 0 0 / 0 742 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.64 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING		TOTAL LOAD CASES: (4)									
CHORDS					WEBS						
MAX. FACTORED		FACTORED			MEMB.		MAX. FACTORED				
MEMB.	FORCE	VERT. LOAD	LC1	MAX	MAX.	MEMB.	FORCE	MAX			
	(LBS)	(PLF)	CSI (LC)		UNBRAC		(LBS)	CSI (LC)			
FR-TO		FROM TO			LENGTH	FR-TO					
R-A	-3851 / 0	0.0	0.0	0.44 (1)	8.01	A-Q	0 / 5428	0.87 (1)			
A-S	-5722 / 0	-91.8	-91.8	0.25 (1)	4.72	K-I	0 / 8717	0.83 (1)			
S-T	-5722 / 0	-91.8	-91.8	0.26 (1)	4.72	K-H	-2763 / 0	0.33 (1)			
T-B	-5722 / 0	-91.8	-91.8	0.25 (1)	4.72	C-B	-2710 / 0	0.32 (1)			
B-C	-5846 / 0	-91.8	-91.8	0.27 (1)	3.93	M-H	0 / 4038	0.50 (1)			
C-D	-10219 / 0	-91.8	-91.8	0.34 (1)	3.64	B-O	0 / 3700	0.46 (1)			
D-U	-10219 / 0	-91.8	-91.8	0.34 (1)	3.64	M-G	-1891 / 0	0.23 (1)			
U-E	-10219 / 0	-91.8	-91.8	0.34 (1)	3.64	C-G	-1400 / 0	0.17 (1)			
E-V	-10219 / 0	-91.8	-91.8	0.31 (1)	3.67	N-C	0 / 2591	0.32 (1)			
V-F	-10219 / 0	-91.8	-91.8	0.31 (1)	3.67	C-N	0 / 1826	0.20 (1)			
F-G	-10219 / 0	-91.8	-91.8	0.31 (1)	3.67	N-E	-710 / 0	0.08 (1)			
G-H	-8031 / 0	-91.8	-91.8	0.23 (1)	4.14						
H-I	-4822 / 0	-91.8	-91.8	0.15 (1)	5.25						
I-J	-3071 / 0	0.0	0.0	0.35 (1)	6.80						

R-W	0 / 0	-18.5 -18.5 0.15 (1) 10.00
W-X	0 / 0	-18.5 -18.5 0.15 (1) 10.00
X-Y	0 / 0	-18.5 -18.5 0.15 (1) 10.00
Y-Q	0 / 0	-18.5 -18.5 0.15 (1) 10.00
Q-P	0 / 5722	-18.5 -18.5 0.44 (1) 10.00
P-O	0 / 5722	-18.5 -18.5 0.44 (1) 10.00
O-Z	0 / 8846	-18.5 -18.5 0.81 (1) 10.00
Z-AA	0 / 8846	-18.5 -18.5 0.81 (1) 10.00
AA-N	0 / 8846	-18.5 -18.5 0.81 (1) 10.00
N-AB	0 / 8031	-18.5 -18.5 0.74 (1) 10.00
AB-AC	0 / 8031	-18.5 -18.5 0.74 (1) 10.00
AC-M	0 / 8031	-18.5 -18.5 0.74 (1) 10.00
M-L	0 / 4622	-18.5 -18.5 0.33 (1) 10.00
L-K	0 / 4622	-18.5 -18.5 0.33 (1) 10.00
K-J	0 / 0	-18.5 -18.5 0.04 (4) 10.00

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
S	1-10-12	-110	-110	---	---	BACK	VERT	TOTAL	---	C1
T	3-10-12	-110	-110	---	---	BACK	VERT	TOTAL	---	C1
U	15-8-12	-110	-110	---	---	BACK	VERT	TOTAL	---	C1
V	17-8-12	-110	-110	---	---	BACK	VERT	TOTAL	---	C1
W	1-10-12	-26	-26	---	---	BACK	VERT	TOTAL	---	C1
X	3-10-12	-26	-26	---	---	BACK	VERT	TOTAL	---	C1
Y	5-1-8	-727	-727	---	---	BACK	VERT	TOTAL	---	C1
Z	13-0-8	-727	-727	---	---	BACK	VERT	TOTAL	---	C1
AA	15-8-12	-26	-26	---	---	BACK	VERT	TOTAL	---	C1
AB	17-8-12	-26	-26	---	---	BACK	VERT	TOTAL	---	C1

TOTAL WEIGHT = 2 X 176 = 353 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 5.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.16")
CALCULATED VERT. DEFL. (LL) = L/999 (0.28")
ALLOWABLE DEFL. (TL) = L/360 (1.16")
CALCULATED VERT. DEFL. (TL) = L/828 (0.50")
CSI: TC=0.44/(1.00 (A-R:1), BC=0.81/(1.00 (N-O:1), WB=0.88/(1.00 (A-Q:1), SS=0.41/(1.00 (M-N:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.88 (M) (INPUT = 0.90)
JSI METAL = 0.50 (P) (INPUT = 1.00)

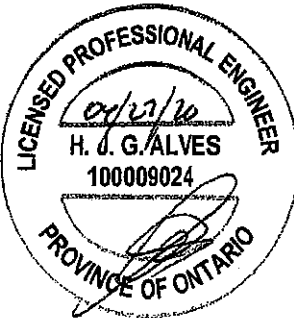

Structural component only
DWG# T-2007064 1/L

JOB NAME 408150	TRUSS NAME T1Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 11:02:49 2020 Page 2 ID: i7vF7aG0E03cRU6X1iSkzjWYK-SrdVvTO3 UVGPVZTPnKeJDIEF7bWig7 NRzNCna	

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	6.0	9.0		Edge
B	TMWW-1	MT20	5.0	6.0	2.50	2.75
C	TMWW-1	MT20	5.0	6.0		
D	TS-1	MT20	5.0	6.0		
E	TMW-w	MT20	3.0	6.0		
F	TS-1	MT20	5.0	6.0		
G	TMWW-1	MT20	5.0	6.0		
H	TMWW-1	MT20	5.0	6.0	2.50	2.75
I	TMVW-1	MT20	6.0	9.0		Edge
J	BMV1-p	MT20	3.0	6.0		
K	BMWW-1	MT20	6.0	9.0	3.00	4.25
L	BS-1	MT20	5.0	6.0		
M	BMWW-1	MT20	5.0	6.0	2.50	2.75
N	BMWW-1	MT20	5.0	6.0		
O	BMWW-1	MT20	5.0	6.0	2.50	2.75
P	BS-1	MT20	5.0	6.0		
Q	BMWW-1	MT20	6.0	9.0	3.00	4.25
R	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
AC	18-3-8	-1293	-1293		BACK	VERT	TOTAL		C1


CONNECTION REQUIREMENTS

- C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007064 72

JOB NAME 408150	TRUSS NAME T2	QUANTITY 2	PLY 1	JOB DESC GREEN PARK HOMES	DRWG NO.
Famarack Roof Truss, Burlington				TRUSS DESC.	
Version 8.310 S Oct 29 2019 M/Tak Industries, Inc. Sat Apr 25 11:02:50 2020 Page 1					
ID:7vF7aG0E03cRUJ6X1jSrkzWYK-w1MqFT2qldMuZ4H181ZBXmNxeiP5W13npxzHzNCnZ					
Scale = 1:24.0					

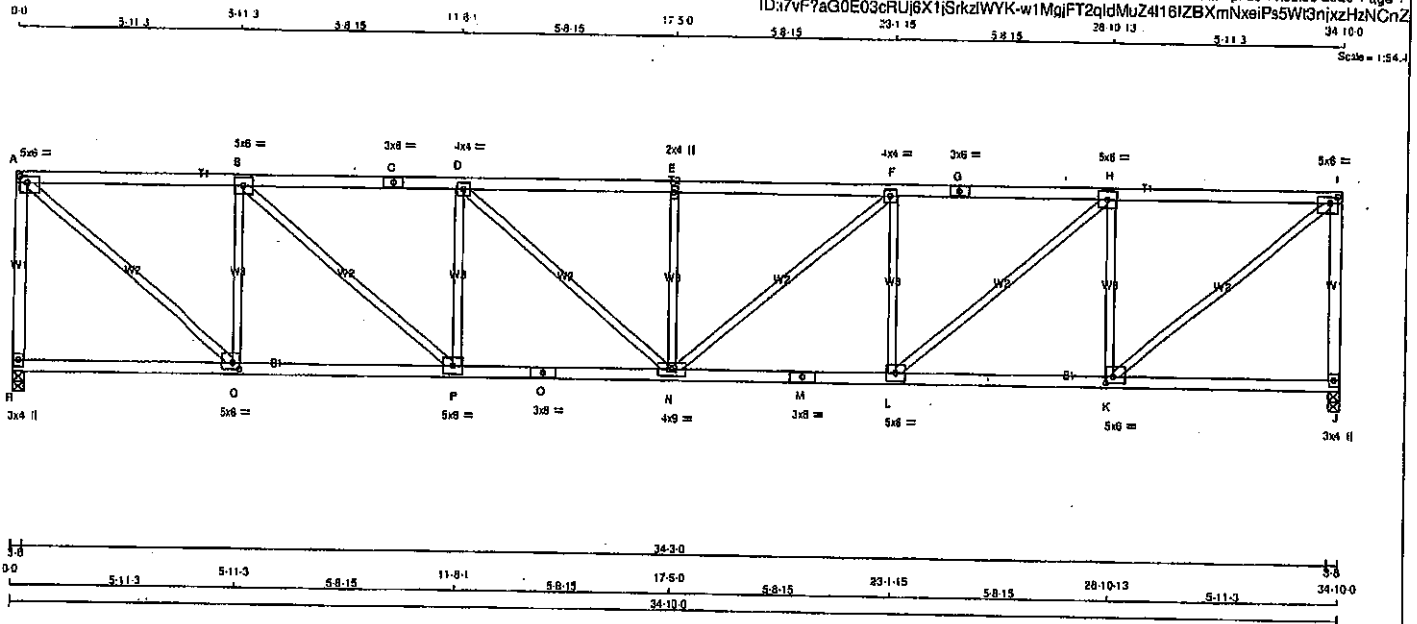

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
R - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
C - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - J	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

PLATES (Table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
A	TMVW-1	MT20	5.0	8.0 2.00 2.25
B	TMVW-1	MT20	5.0	8.0
C	TS-1	MT20	3.0	8.0
D	TMVW-1	MT20	4.0	4.0
E	TMVW-1	MT20	2.0	4.0
F	TMVW-1	MT20	4.0	4.0
G	TS-1	MT20	3.0	8.0
H	TMVW-1	MT20	5.0	8.0
I	TMVW-1	MT20	5.0	8.0 2.00 2.25
J	BMV1+p	MT20	3.0	4.0
K	BMVW-1	MT20	5.0	8.0 2.00 2.25
L	BMVW-1	MT20	5.0	8.0
M	BS-1	MT20	3.0	8.0
N	BMVW-1	MT20	4.0	8.0
O	BS-1	MT20	3.0	8.0
P	BMVW-1	MT20	5.0	8.0
Q	BMVW-1	MT20	5.0	8.0 2.00 2.25
R	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
R	1920	0	1920	0	3-8	3-8	
J	1920	0	1920	0	3-8	3-8	

UNFACTORED REACTIONS

1ST CASE	MAX MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1358	891 / 0	0 / 0	0 / 0	0 / 0	467 / 0	0 / 0
J	1358	891 / 0	0 / 0	0 / 0	0 / 0	467 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.23 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
R-A	-1875 / 0	0.0	0.0 0.83 (1)	K-I	0 / 2630	0.58 (1)	
A-B	-2042 / 0	-91.8	-91.8 0.59 (1)	A-Q	0 / 2630	0.59 (1)	
B-C	-3149 / 0	-91.8	-91.8 0.74 (1)	K-H	-1535 / 0	0.59 (1)	
C-D	-3149 / 0	-91.8	-91.8 0.74 (1)	Q-B	-1535 / 0	0.59 (1)	
D-E	-3533 / 0	-91.8	-91.8 0.88 (1)	L-H	0 / 1444	0.33 (1)	
E-F	-3533 / 0	-91.8	-91.8 0.88 (1)	B-P	0 / 1444	0.33 (1)	
F-G	-3149 / 0	-91.8	-91.8 0.74 (1)	L-F	-828 / 0	0.32 (1)	
G-H	-3149 / 0	-91.8	-91.8 0.74 (1)	P-O	-828 / 0	0.32 (1)	
H-I	-2042 / 0	-91.8	-91.8 0.59 (1)	N-F	0 / 502	0.11 (1)	
J-I	-1875 / 0	0.0	0.0 0.83 (1)	D-N	0 / 502	0.11 (1)	
R-Q	0 / 0	-18.5	-18.5 0.15 (4)	N-E	-537 / 0	0.21 (1)	
Q-P	0 / 2042	-18.5	-18.5 0.40 (1)				
P-O	0 / 3149	-18.5	-18.5 0.59 (1)				
O-N	0 / 3149	-18.5	-18.5 0.59 (1)				
N-M	0 / 3149	-18.5	-18.5 0.59 (1)				
M-L	0 / 3149	-18.5	-18.5 0.59 (1)				
L-K	0 / 2042	-18.5	-18.5 0.40 (1)				
K-J	0 / 0	-18.5	-18.5 0.15 (4)				

TOTAL WEIGHT = 2 X 143 = 286 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (1.16")
CALCULATED VERT. DEFL. (LL) = $L/889$ (0.23")
ALLOWABLE DEFL. (TL) = $L/360$ (1.16")
CALCULATED VERT. DEFL. (TL) = $L/988$ (0.42")

CSI: TC=0.83/1.00 (A-R:1), BC=0.58/1.00 (N-P:1), WB=0.59/1.00 (K-I:1), SS=0.25/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP (DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
MT20	618	354	1887
	618	354	1887

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (A) (INPUT = 0.90)
JSI METAL = 0.99 (M) (INPUT = 1.00)



Structural component only
DWG# T-2007065

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408150	T3	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 11:02:51 2020 Page 1					
ID:7v7aG0E03cRUj6X1jSrkzIWK-0Ew2wbUhbclDWjxbqokJJaK233bSy0iRTUvzNcNv					
Scale = 1/8" = 1'-0"					

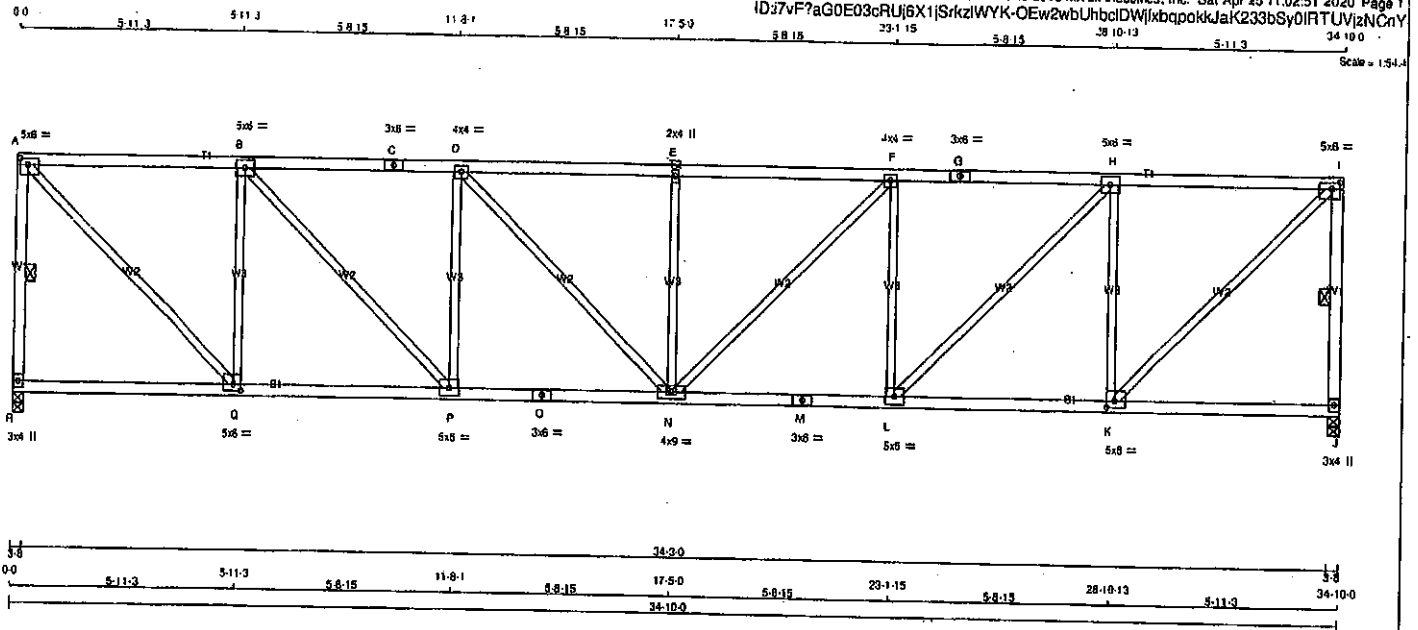

LUMBER	SIZE	LUMBER	DESCR.
N. L. G. A. RULES			
CHORDS			
A - C	2x4 DRY	No.2	SPF
C - G	2x4 DRY	No.2	SPF
G - I	2x4 DRY	No.2	SPF
I - J	2x4 DRY	No.2	SPF
R - O	2x4 DRY	No.2	SPF
O - M	2x4 DRY	No.2	SPF
M - J	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
DRY: SEASONED LUMBER.			

PLATES (table in inches)	W	LEN	Y	X
JT TYPE				
A TMWV-1	MT20	5.0	6.0	2.00 2.50
B TMWV-1	MT20	5.0	6.0	
C TS-1	MT20	3.0	6.0	
D TMWV-1	MT20	4.0	4.0	
E TMWV-1	MT20	2.0	4.0	
F TMWV-1	MT20	4.0	4.0	
G TS-1	MT20	3.0	6.0	
H TMWV-1	MT20	5.0	6.0	
I TMWV-1	MT20	5.0	6.0	2.00 2.50
J BMV1+p	MT20	3.0	4.0	
K BMWV-1	MT20	5.0	6.0	2.00 2.50
L BMWV-1	MT20	5.0	6.0	
M BS-1	MT20	3.0	6.0	
N BMWV-1	MT20	4.0	9.0	
O BS-1	MT20	3.0	6.0	
P BMWV-1	MT20	5.0	6.0	
Q BMWV-1	MT20	5.0	6.0	2.00 2.50
R BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
R 1920	DOWN	HORIZ	UPLIFT	IN-SX
J 1920	0	1920	0	3-8
	0	1920	0	3-8
	0	1920	0	3-8
UNFACTORED REACTIONS	1ST LCASE	MAX. MIN. COMPONENT REACTIONS		
JT COMBINED	SNOW	LIVE	PERM.LIVE	WIND
R 1358	891 / 0	0 / 0	0 / 0	467 / 0
J 1358	891 / 0	0 / 0	0 / 0	467 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.59 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-R, J-I.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORIZ. LOAD (PLF)	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH
FR-TO						FR-TO			
R-A	-1875 / 0	0.0	0.0	0.33 (1)	4.90	K-I	0 / 2368	0.53 (1)	
A-B	-1891 / 0	-91.8	-91.8	0.55 (1)	4.48	A-D	0 / 2368	0.53 (1)	
B-C	-2808 / 0	-91.8	-91.8	0.68 (1)	3.63	K-H	-1536 / 0	0.90 (1)	
C-D	-2808 / 0	-91.8	-91.8	0.68 (1)	3.63	Q-B	-1536 / 0	0.90 (1)	
D-E	-2927 / 0	-91.8	-91.8	0.58 (1)	3.59	L-H	0 / 1304	0.29 (1)	
E-F	-2927 / 0	-91.8	-91.8	0.58 (1)	3.59	B-P	0 / 1304	0.29 (1)	
F-G	-2808 / 0	-91.8	-91.8	0.68 (1)	3.63	L-F	-826 / 0	0.48 (1)	
G-H	-2808 / 0	-91.8	-91.8	0.68 (1)	3.63	P-D	-826 / 0	0.48 (1)	
H-I	-1891 / 0	-91.8	-91.8	0.55 (1)	4.48	N-F	0 / 453	0.10 (1)	
J-I	-1875 / 0	0.0	0.0	0.33 (1)	4.90	D-N	0 / 453	0.10 (1)	
						N-E	-537 / 0	0.31 (1)	
R-Q	0 / 0	-18.5	-18.5	0.15 (4)	10.00				
Q-P	0 / 1891	-18.5	-18.5	0.35 (1)	10.00				
P-O	0 / 2808	-18.5	-18.5	0.47 (1)	10.00				
O-N	0 / 2808	-18.5	-18.5	0.47 (1)	10.00				
N-M	0 / 2808	-18.5	-18.5	0.47 (1)	10.00				
M-L	0 / 2808	-18.5	-18.5	0.47 (1)	10.00				
L-K	0 / 1891	-18.5	-18.5	0.35 (1)	10.00				
K-J	0 / 0	-18.5	-18.5	0.15 (4)	10.00				

TOTAL WEIGHT = 2 X 153 = 305 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.18")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.33")

CSI: TC=0.68/1.00 (F-H:1), BC=0.47/1.00 (N-P:1), WB=0.90/1.00 (H-K:1), SS=0.25/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1887 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (I) (INPUT = 0.90)
JSI METAL = 0.83 (M) (INPUT = 1.00)




Structural component only
DWG# T-2007066

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408150	T4	2	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 11:02:52 2020 Page 1
IDj7vF7aG0E03cRUj6X1jSkziWYK-sQUQ8wVJMv47IE88XL1GyrhNSQJK?99W4C12AzNCnX

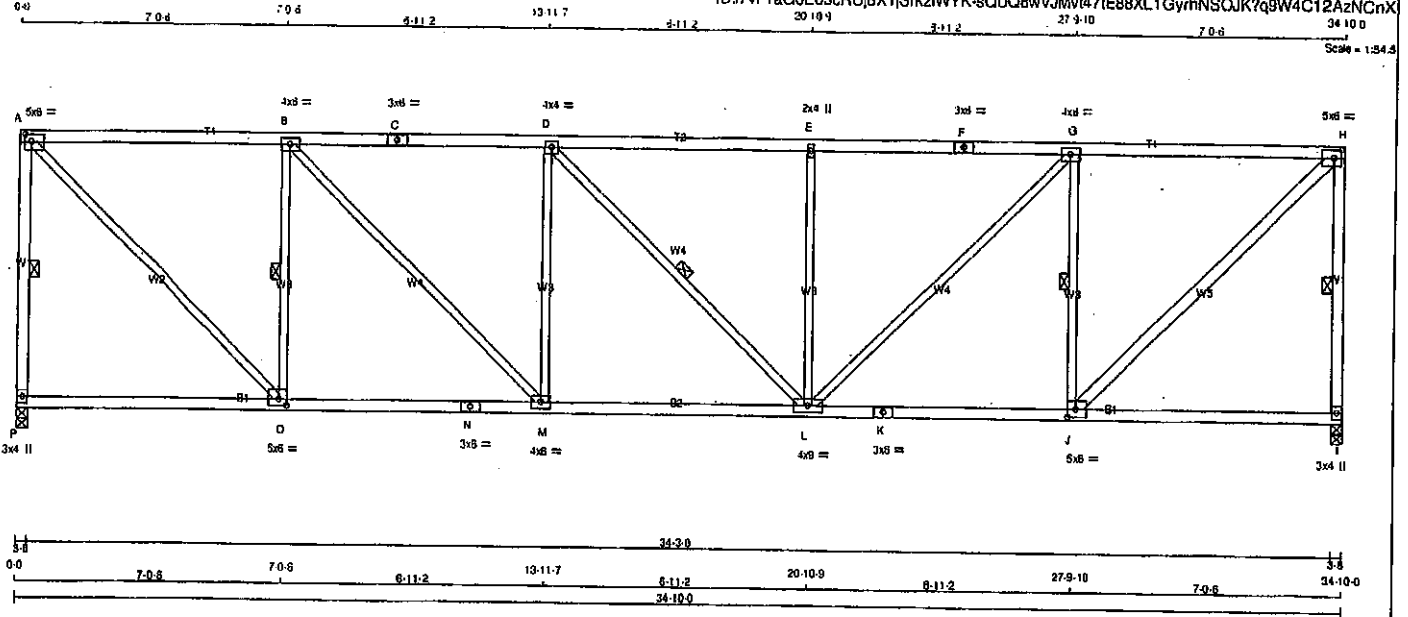

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
P - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
I - H	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT	J - H	2x4	DRY
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW-1	MT20	5.0	8.0	2.25 2.00
B	TMVW-1	MT20	4.0	8.0	
C	TS-1	MT20	3.0	8.0	
D	TMVW-1	MT20	4.0	8.0	
E	TS-1	MT20	2.0	4.0	
F	TMVW-1	MT20	3.0	8.0	
G	TMVW-1	MT20	4.0	8.0	
H	TMVW-1	MT20	5.0	8.0	2.50 2.50
I	BMV1+p	MT20	3.0	4.0	
J	BMVW-1	MT20	5.0	8.0	2.50 2.50
K	BS-1	MT20	3.0	8.0	
L	BMVW-1	MT20	4.0	8.0	
M	BMVW-1	MT20	4.0	8.0	
N	BS-1	MT20	3.0	8.0	
O	BMVW-1	MT20	5.0	8.0	2.00 2.50
P	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	BRG	IN-SX	IN-SX
P	1920	0	1920	0	0	3-8	3-8		
I	1920	0	1920	0	0	3-8	3-8		

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
P	1358	891 / 0	0 / 0	0 / 0	0 / 0	487 / 0	0 / 0
I	1358	891 / 0	0 / 0	0 / 0	0 / 0	487 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.31 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-P, H-I, B-O, D-L, G-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
P-A	-1868 / 0	0.0	0.0 0.43 (1)	A-O	0 / 2315	0.52 (1)	
A-B	-1662 / 0	-91.8	-91.8 0.82 (1)	O-B	-1466 / 0	0.47 (1)	
B-C	-2416 / 0	-91.8	-91.8 0.95 (1)	B-M	0 / 1058	0.24 (1)	
C-D	-2416 / 0	-91.8	-91.8 0.95 (1)	M-D	-817 / 0	0.54 (1)	
D-E	-2415 / 0	-91.8	-91.8 0.74 (1)	D-L	-2 / 0	0.00 (1)	
E-F	-2415 / 0	-91.8	-91.8 0.98 (1)	L-E	-616 / 0	0.54 (1)	
F-G	-2415 / 0	-91.8	-91.8 0.98 (1)	L-G	0 / 1054	0.24 (1)	
G-H	-1663 / 0	-91.8	-91.8 0.82 (1)	J-G	-1465 / 0	0.47 (1)	
H-I	-1868 / 0	0.0	0.0 0.43 (1)	J-H	0 / 2316	0.37 (1)	
P-O	0 / 0	-18.5	-18.5 0.22 (4)				
O-N	0 / 1682	-18.5	-18.5 0.39 (1)				
N-M	0 / 1682	-18.5	-18.5 0.39 (1)				
M-L	0 / 2416	-18.5	-18.5 0.47 (1)				
L-K	0 / 1663	-18.5	-18.5 0.39 (1)				
K-J	0 / 1663	-18.5	-18.5 0.39 (1)				
J-I	0 / 0	-18.5	-18.5 0.22 (4)				

TOTAL WEIGHT = 2 X 157 = 313 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.16")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.15")
ALLOWABLE DEFL.(TL) = $L/360$ (1.16")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.29")

CSI: TC=0.86/1.00 (E-G:1), BC=0.47/1.00 (L-M:1), WB=0.54/1.00 (D-M:1), SS=0.30/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00.

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 768	1667 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.90 (A) (INPUT = 0.90)
JSI METAL = 0.53 (K) (INPUT = 1.00)



Structural component only
DWG# T-2007067

JOB NAME 408150	TRUSS NAME T5	QUANTITY 10	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITak Industries, Inc. Sat Apr 25 11:02:53 2020 Page 1
ID:7vF7aG0E03cRUj6X1jSkzIWK-Kc2pLGWx7D7x0pKIFsGp9Os5sl3ONJkybacZNCrW
20 10.6 27.9 34.9 34.10.0
34.9 34.10.0
Scale = 1:54.3

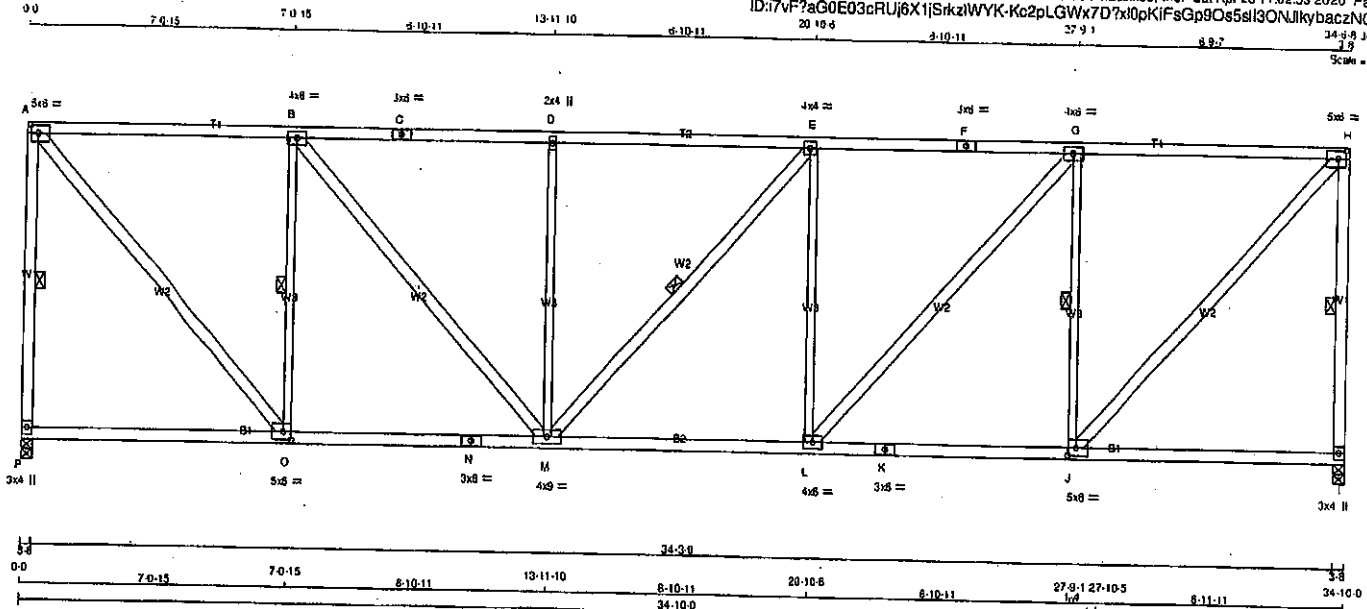

LUMBER	N.L.G.A. RULES	CHORDS	SIZE	DRY	LUMBER
P - A	2x4	DRY	No.2		
A - C	2x4	DRY	No.2		
C - F	2x4	DRY	No.2		
F - H	2x4	DRY	No.2		
H - I	2x4	DRY	No.2		
I - N	2x4	DRY	No.2		
N - K	2x4	DRY	No.2		
K - I	2x4	DRY	No.2		

ALL WEBS	EXCEPT	SIZE	DRY	LUMBER
J - G	2x3	DRY	No.2	
O - B	2x3	DRY	No.2	
L - E	2x3	DRY	No.2	
M - D	2x3	DRY	No.2	

DRY: SEASONED LUMBER.

PLATES (table/s in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	5.0	8.0	2.50	2.50
B	TMVW-1	MT20	4.0	6.0		
C	TS-1	MT20	3.0	4.0		
D	TMVW-1	MT20	2.0	4.0		
E	TMVW-1	MT20	4.0	4.0		
F	TS-1	MT20	3.0	6.0		
G	TMVW-1	MT20	4.0	8.0		
H	TMVW-1	MT20	5.0	8.0	2.50	2.50
I	BMV1-p	MT20	3.0	4.0		
J	BMVW-1	MT20	5.0	8.0	2.50	2.50
K	BS-1	MT20	3.0	6.0		
L	BMVW-1	MT20	4.0	8.0		
M	BMVW-1	MT20	4.0	9.0		
N	BS-1	MT20	3.0	6.0		
O	BMVW-1	MT20	5.0	8.0	2.50	2.50
P	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
P	1920	0	1920	0	3-8	3-8
I	1920	0	1920	0	3-8	3-8

UNFACTORED REACTIONS

JT	1ST CASE		MAX/MIN COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
P	1358	891/0	0/0	0/0	0/0	467/0	0/0
I	1358	891/0	0/0	0/0	0/0	467/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-P, H-I, G-J, B-O, E-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM	TO		FR-TO		
P-A	-1888 / 0	0.0	0.0	0.55 (1)	4.91	J-H	0 / 2171 0.35 (1)
A-B	-1458 / 0	-91.8	-91.8	0.80 (1)	4.28	A-O	0 / 2171 0.35 (1)
B-C	-2108 / 0	-91.8	-91.8	0.90 (1)	3.58	J-G	-1483 / 0 0.61 (1)
C-D	-2108 / 0	-91.8	-91.8	0.80 (1)	3.58	O-B	-1482 / 0 0.61 (1)
D-E	-2108 / 0	-91.8	-91.8	0.68 (1)	4.00	L-G	0 / 982 0.18 (1)
E-F	-2108 / 0	-91.8	-91.8	0.90 (1)	3.58	B-M	0 / 980 0.18 (1)
F-G	-2108 / 0	-91.8	-91.8	0.90 (1)	3.58	L-E	-613 / 0 0.78 (1)
G-H	-1458 / 0	-91.8	-91.8	0.79 (1)	4.27	M-D	-612 / 0 0.77 (1)
H-I	-1888 / 0	0.0	0.0	0.55 (1)	4.91	M-E	-2 / 0 0.00 (1)
P-O	0 / 0	-18.5	-18.5	0.22 (4)	10.00		
O-N	0 / 1458	-18.5	-18.5	0.36 (1)	10.00		
N-M	0 / 1458	-18.5	-18.5	0.36 (1)	10.00		
M-L	0 / 2108	-18.5	-18.5	0.42 (1)	10.00		
L-K	0 / 1458	-18.5	-18.5	0.36 (1)	10.00		
K-J	0 / 1458	-18.5	-18.5	0.36 (1)	10.00		
J-I	0 / 0	-18.5	-18.5	0.22 (4)	10.00		

TOTAL WEIGHT = 10 X 178 = 1785 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (1.16")
CALCULATED VERT. DEFL. (LL) = $L/989$ (0.12")
ALLOWABLE DEFL. (TL) = $L/360$ (1.16")
CALCULATED VERT. DEFL. (TL) = $L/989$ (0.24")

CSF: TC=0.90/1.00 (B-D:1), BC=0.42/1.00 (L-M:1), WB=0.78/1.00 (E-L:1), SB=0.31/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX	MIN	MAX
MT20	618	354
	1967	788
	1987	1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (A) (INPUT = 0.90)
JSI METAL = 0.47 (N) (INPUT = 1.00)



Structural component only
DWG# T-2007068



BEARINGS							
FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
M	1888	0	1888	0	0	5-8	5-8
H	1422	0	1422	0	0	5-8	5-8

UNFACTORED REACTIONS			
1ST LEASE		MAX. MIN. COMPONENT REACTIONS	
IT	20	20	20

	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
M	1329	909 / 0	0 / 0	0 / 0	0 / 0	420 / 0	0 / 0
H	1001	683 / 0	0 / 0	0 / 0	0 / 0	318 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.55 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED		MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED	
		VERT. LOAD	LC1 MAX. (PLF) CSI (LC)			UNBRAC LENGTH	FR-TO CSI (LC)
FR-TO							
A-B	0.41	-81.8	-0.18	0.11			

B-C	-1847/0	-91.8	-91.8	0.34 (1)	4.55	C-K	0/310	0.08 (1)
C-D	-1841/0	-91.8	-91.8	0.38 (1)	4.72	K-D	-481/0	0.16 (1)

D-E	-1641/0	-91.8	-91.8	0.36 (1)	4.72	K-E	0/1010	0.25 (1)
E-F	-1225/0	-91.8	-91.8	0.30 (1)	5.40	I-E	274/0	0.09 (1)
F-G	0/141	0.18	-91.8	-0.14 (1)	10.00	G-L	0/1480	0.37 (1)
M-B	-1926/0	0.0	0.0	0.22 (1)	6.01	I-F	0/981	0.24 (1)
H-F	-1380/0	0.0	0.0	0.16 (1)	8.88			
M-N	0/0	-18.5	-18.5	0.24 (1)	10.00			
N-L	0/0	-18.5	-18.5	0.24 (1)	10.00			
L-O	0/1424	-18.5	-18.5	0.70 (1)	10.00			
O-K	0/1424	-18.5	-18.5	0.70 (1)	10.00			
K-J	0/932	-18.5	-18.5	0.29 (1)	10.00			
I-I	0/832	-18.5	-18.5	0.29 (1)	10.00			
H	0/0	-18.5	-18.5	0.04 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)									
T	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
1	3-10-8	241	244		533-17	WEST	FL		

3-10-6	-241	-241	...	FRONT	VERT	TOTAL	...	C1
3-11-4	-17	-17	...	FRONT	VERT	TOTAL	...	C1
2-0-12	-17	-17	...	FRONT	VERT	TOTAL	...	C1
5-6-8	-953	-953	...	FRONT	VERT	TOTAL	...	C1

CONNECTION REQUIREMENTS

7) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

8

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR

THIS DESIGN COMPLIES WITH:
PART 9 OF BCBC 2018, OBC 2012, ABC 2018
PART 9 OF OBC 2012 (SEALING REQUIREMENTS)

55 % OF 31.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF

ALLOWABLE DEFL.(LL) = $L/360$ (0.55")
 CALCULATED VERT. DEFL.(LL) = $L/989$ (0.08")
 ALLOWABLE DEFL.(TL) = $L/360$ (0.55")

WB=0.37/1.00 (B-L:1) , SSI=0.45/1.00 (K-L:1)

COMPRESSION LIVE LOAD FACTOR = 1.00

TAIL VALUES
DATE 05/10/2010 SHEAR DESIGN

LATE PLACEMENT TOL. = 0.250 inches


SI GRIP= 0.89 (C) (INPUT = 0.90)
SI METAL= 0.57 (J) (INPUT = 1.00)

100

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	38	39	40	41	42	43	44	45	46	47	48	49	50	51	52	53	54	55	56	57	58	59	60	61	62	63	64	65	66	67	68	69	70	71	72	73	74	75	76	77	78	79	80	81	82	83	84	85	86	87	88	89	90	91	92	93	94	95	96	97	98	99	100	101	102	103	104	105	106	107	108	109	110	111	112	113	114	115	116	117	118	119	120	121	122	123	124	125	126	127	128	129	130	131	132	133	134	135	136	137	138	139	140	141	142	143	144	145	146	147	148	149	150	151	152	153	154	155	156	157	158	159	160	161	162	163	164	165	166	167	168	169	170	171	172	173	174	175	176	177	178	179	180	181	182	183	184	185	186	187	188	189	190	191	192	193	194	195	196	197	198	199	200	201	202	203	204	205	206	207	208	209	210	211	212	213	214	215	216	217	218	219	220	221	222	223	224	225	226	227	228	229	230	231	232	233	234	235	236	237	238	239	240	241	242	243	244	245	246	247	248	249	250	251	252	253	254	255	256	257	258	259	260	261	262	263	264	265	266	267	268	269	270	271	272	273	274	275	276	277	278	279	280	281	282	283	284	285	286	287	288	289	290	291	292	293	294	295	296	297	298	299	300	301	302	303	304	305	306	307	308	309	310	311	312	313	314	315	316	317	318	319	320	321	322	323	324	325	326	327	328	329	330	331	332	333	334	335	336	337	338	339	340	341	342	343	344	345	346	347	348	349	350	351	352	353	354	355	356	357	358	359	360	361	362	363	364	365	366	367	368	369	370	371	372	373	374	375	376	377	378	379	380	381	382	383	384	385	386	387	388	389	390	391	392	393	394	395	396	397	398	399	400	401	402	403	404	405	406	407	408	409	410	411	412	413	414	415	416	417	418	419	420	421	422	423	424	425	426	427	428	429	430	431	432	433	434	435	436	437	438	439	440	441	442	443	444	445	446	447	448	449	450	451	452	453	454	455	456	457	458	459	460	461	462	463	464	465	466
---	---	---	---	---	---	---	---	---	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----

JOB NAME 408150	TRUSS NAME T7	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Sat Apr 25 11:02:55 2020 Page 1
 ID:1v7F7aG0E03cRUj6X1jSrkziWYK-G7AZmyXBqFI_Ky(qfukuaTK3IVZXS_cD2RIIVzNCnU

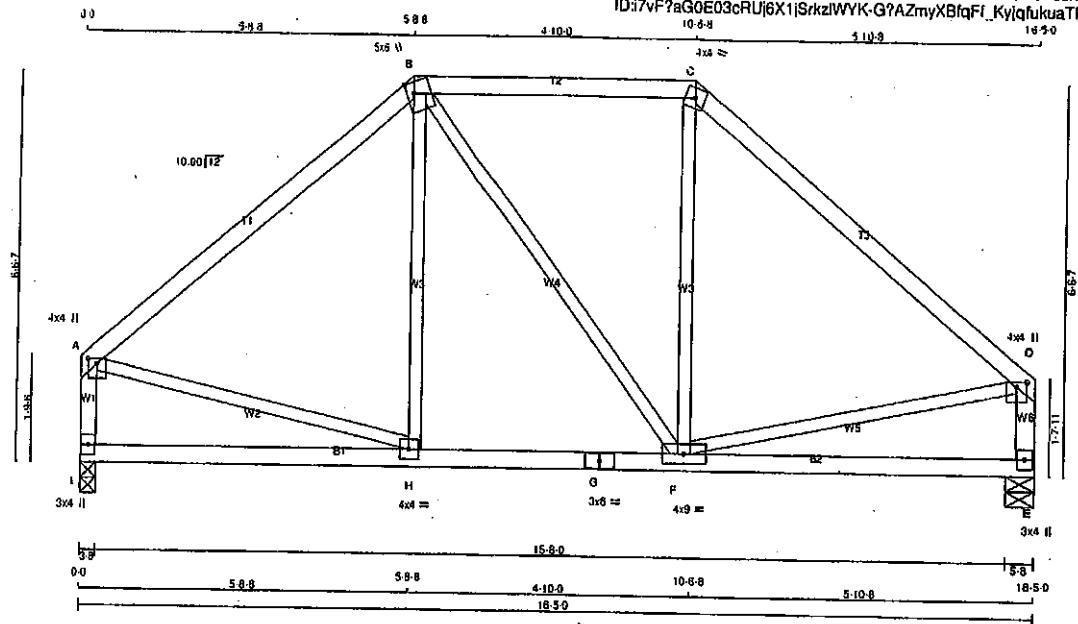

TOTAL WEIGHT = 70 lb [M/F]

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF
B - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
I - A	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF
I - G	2x4	DRY	No.2	SPF
G - E	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.00	2.00
B	TTWW+m	MT20	5.0	6.0	2.25	1.50
C	TTW-m	MT20	4.0	4.0		
D	TMVW+p	MT20	4.0	4.0	1.00	2.00
E	BMV1+p	MT20	3.0	4.0		
F	BMWWW-t	MT20	4.0	9.0		
G	BS-t	MT20	3.0	6.0		
H	BMWW-t	MT20	4.0	4.0		
I	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
I	905	0	905	0	3-8	3-8
E	905	0	905	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX/MIN COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
I	840	420 / 0	0 / 0	0 / 0	0 / 0	220 / 0	0 / 0
E	840	420 / 0	0 / 0	0 / 0	0 / 0	220 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I, E

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO			FR-TO			
A-B	-718 / 0	-91.8	-91.8	0.39 (1)	6.25	H-B	-34 / 68	0.02 (4)
B-C	-558 / 0	-91.8	-91.8	0.28 (1)	6.25	B-F	0 / 14	0.00 (1)
C-D	-729 / 0	-91.8	-91.8	0.42 (1)	6.25	F-C	-23 / 74	0.03 (4)
I-A	-860 / 0	0.0	0.0	0.09 (1)	7.81	A-H	0 / 567	0.13 (1)
E-D	-858 / 0	0.0	0.0	0.09 (1)	7.81	F-D	0 / 572	0.13 (1)
I-H	0 / 0	-18.5	-18.5	0.13 (4)	10.00			
H-G	0 / 550	-18.5	-18.5	0.18 (4)	10.00			
G-F	0 / 550	-18.5	-18.5	0.18 (4)	10.00			
F-E	0 / 0	-18.5	-18.5	0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.8 PSF
 OL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 OL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.55")
 CALCULATED VERT. DEFL.(LL) = L/989 (0.01")
 ALLOWABLE DEFL.(TL) = L/360 (0.55")
 CALCULATED VERT. DEFL.(TL) = L/989 (0.05")

CSI: TC=0.42/1.00 (C-D:1), BC=0.18/1.00 (F-H:4), WB=0.13/1.00 (D-F:1), SS=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY) (PSI)	SHEAR (PLI)	SECTION	
		MAX MIN	MAX MIN
MT20	618	354	1987 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (D) (INPUT = 0.90)
 JSI METAL = 0.24 (D) (INPUT = 1.00)




Structural component only
 DWG# T-2007070

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408150	T8	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:02:58 2020 Page 1
ID:7VF7aG0E03cRUJ6X1SrkziWYK-IBkxziVpQ8NwUxvNNPzRo0Y13nGGpIIRIAFBzNCnT

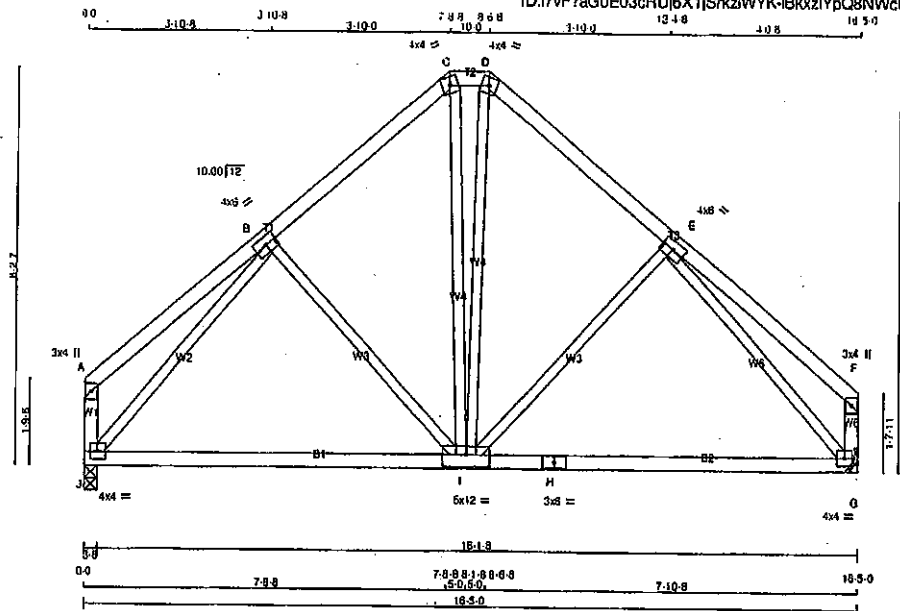

Scale = 1/4" = 1'-0"

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
J - A	2x4	DRY	No.2
G - F	2x4	DRY	No.2
J - H	2x4	DRY	No.2
H - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			SPF

DRY, SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B	TMWV-t	MT20	4.0	6.0		
C	TTW-m	MT20	4.0	4.0		
D	TTW-m	MT20	4.0	4.0		
E	TMWV-t	MT20	4.0	6.0		
F	TMV+p	MT20	3.0	4.0		
G	BMVW1-t	MT20	4.0	4.0		
H	BS-1	MT20	3.0	6.0		
I	BMVWVW1-t	MT20	5.0	12.0	3.00	6.00
J	BMVW1-t	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
J	905	0	905	0
G	905	0	905	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	640	420 / 0	0 / 0	0 / 0	0 / 0	220 / 0	0 / 0
G	640	420 / 0	0 / 0	0 / 0	0 / 0	220 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED			
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 27	-91.8 -91.8	0.22 (1)	8-I	-183 / 0	0.11 (1)	
B-C	-649 / 0	-91.8 -91.8	0.17 (1)	I-E	-190 / 0	0.13 (1)	
C-D	-489 / 0	-91.8 -91.8	0.01 (1)	J-B	-930 / 0	0.54 (1)	
D-E	-650 / 0	-91.8 -91.8	0.18 (1)	E-G	-935 / 0	0.57 (1)	
E-F	0 / 27	-91.8 -91.8	0.23 (1)	C-I	0 / 221	0.05 (1)	
J-A	-129 / 0	0.0 0.0	0.01 (1)	I-D	0 / 222	0.05 (1)	
G-F	-137 / 0	0.0 0.0	0.01 (1)				
J-I	0 / 590	-18.5 -18.5	0.41 (4)				
I-H	0 / 608	-18.5 -18.5	0.41 (4)				
H-G	0 / 608	-18.5 -18.5	0.41 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6	PSF
DL	= 6.0	PSF
BOT CH. LL	= 0.0	PSF
DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.55")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.55")
CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CSI: TC=0.23/1.00 (E-F:1), BC=0.41/1.00 (G-I:4), WB=0.57/1.00 (E-G:1), SS=0.13/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	618	354	1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.75 (G) (INPUT = 0.90)
JSI METAL = 0.23 (G) (INPUT = 1.00)

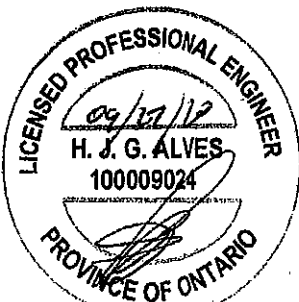

Structural component only
DWG# T-2007071

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408150	T9	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

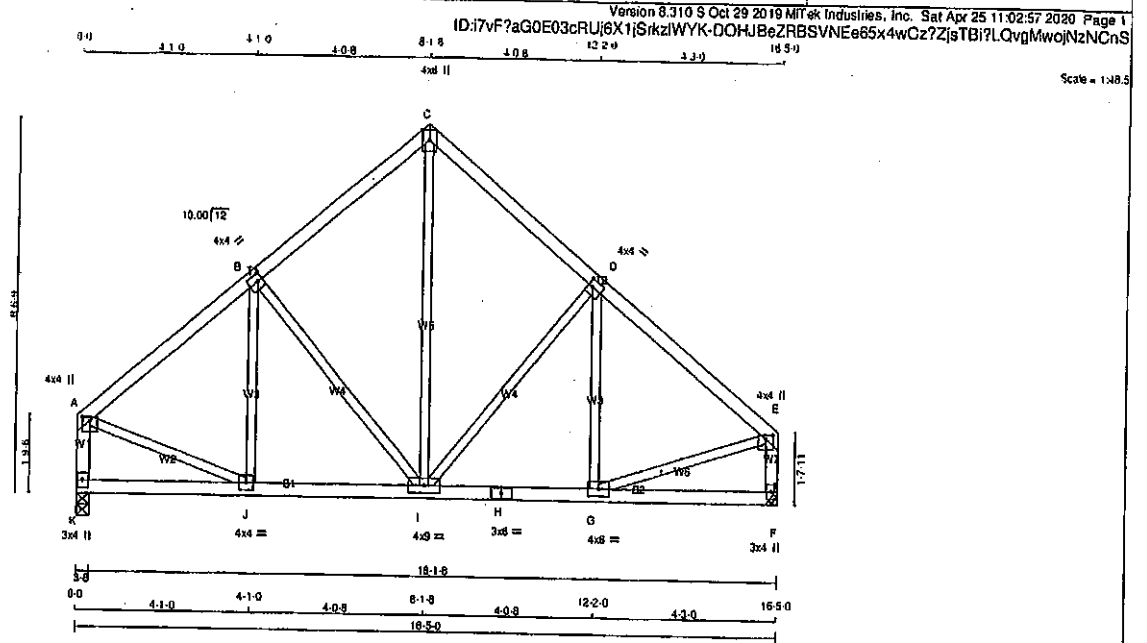

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS			
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
K - A	2x4	DRY	No.2
F - E	2x4	DRY	No.2
K - H	2x4	DRY	No.2
H - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
A - TMVW+p	MT20	4.0	4.0	1.00	2.00
B - TMVW-t	MT20	4.0	4.0	2.00	1.25
C - TTW+p	MT20	4.0	8.0	Edge	
D - TMVW-t	MT20	4.0	4.0	2.00	1.25
E - TMVW+p	MT20	4.0	4.0	1.00	2.00
F - BMV1+p	MT20	3.0	4.0		
G - BMVW-t	MT20	4.0	8.0		
H - BS-t	MT20	3.0	8.0		
I - BMVW-t	MT20	4.0	9.0		
J - BMVW-t	MT20	4.0	4.0		
K - BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGES OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
K	905	0	905	0
F	905	0	905	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3-8.

UNFACTORED REACTIONS

1ST CASE	MAX/MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	840	420 / 0	0 / 0	0 / 0	0 / 0	220 / 0	0 / 0
F	840	420 / 0	0 / 0	0 / 0	0 / 0	220 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED		MEMB.	MAX. FACTORED	FACTORED	
	FORCE	VERT. LOAD	MAX. MAX.		FORCE	MAX.	
	(LBS)	(PLF)	CS1 (LC)		(LBS)	CS1 (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	-772 / 0	-91.8	-91.8	0.20 (1)	8.25	J-B	-135 / 21
B-C	-820 / 0	-91.8	-91.8	0.19 (1)	8.25	B-I	-251 / 0
C-D	-822 / 0	-91.8	-91.8	0.20 (1)	8.25	I-C	0 / 478
D-E	-795 / 0	-91.8	-91.8	0.21 (1)	8.25	I-D	-278 / 0
K-A	-873 / 0	0.0	0.0	0.10 (1)	7.81	G-D	-110 / 31
F-E	-872 / 0	0.0	0.0	0.09 (1)	7.81	A-J	0 / 853
						G-E	0 / 682
K-J	0 / 0	-18.5	-18.5	0.07 (4)	10.00		
J-I	0 / 815	-18.5	-18.5	0.13 (1)	10.00		
I-H	0 / 633	-18.5	-18.5	0.14 (1)	10.00		
H-G	0 / 633	-18.5	-18.5	0.14 (1)	10.00		
G-F	0 / 0	-18.5	-18.5	0.07 (4)	10.00		

TOTAL WEIGHT = 77 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.55")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.02")
ALLOWABLE DEFL. (TL) = $L/360$ (0.55")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.03")

CS1: TC=0.21/1.00 (D-E:1), BC=0.14/1.00 (G-I:1), WB=0.20/1.00 (D-I:1), SS1=0.14/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (E) (INPUT = 0.90)
JSI METAL = 0.24 (E) (INPUT = 1.00)



Structural component only
DWG# T-2007072

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408150	T10S	2	1	GREEN PARK HOMES		
Tamarack Roof Truss, Burlington						

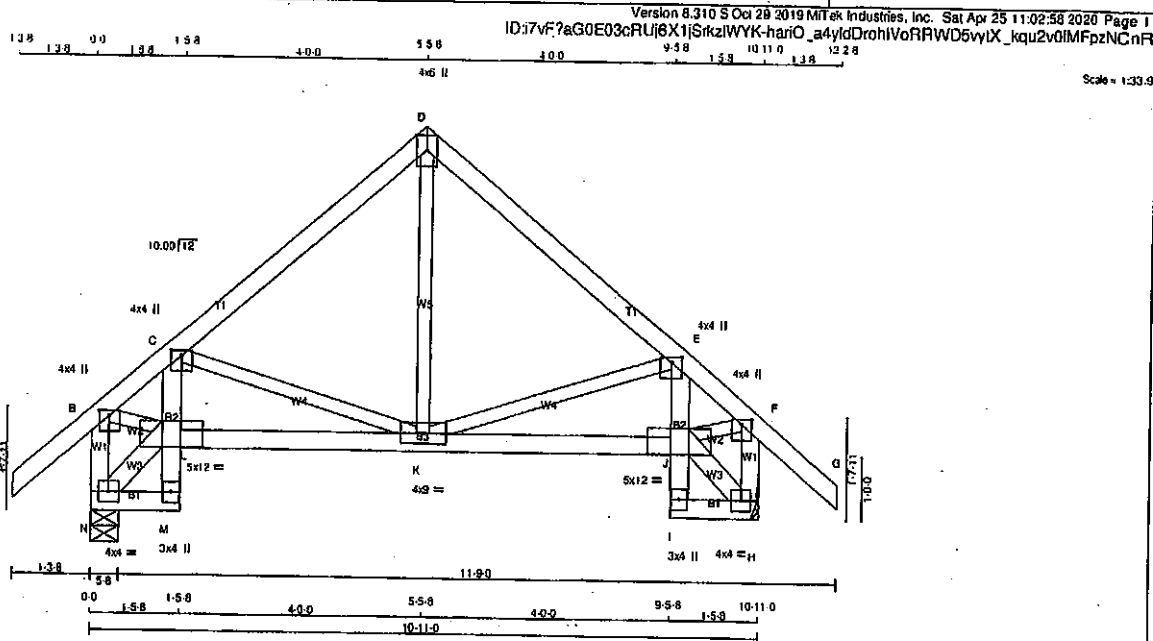

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - B	2x4	DRY	No.2
N - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
N - M	2x4	DRY	No.2
M - C	2x4	DRY	No.2
L - J	2x4	DRY	No.2
I - E	2x4	DRY	No.2
I - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
N - L	2x4	DRY	No.2
J - H	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)				
JT TYPE	PLATES	W	LEN	Y X
B, C, E, F				
B	TMVW+p	MT20	4.0	4.0 1.00 2.00
D	TTW+p	MT20	4.0	6.0 Edge
H	BMVW1-t	MT20	4.0	4.0
I	BMV+p	MT20	3.0	4.0
J	BVMW1-t	MT20	5.0	12.0 5.00 7.75
K	BVMW1-t	MT20	4.0	9.0
L	BVMW1-t	MT20	5.0	12.0 5.00 7.75
M	BMV+p	MT20	3.0	4.0
N	BMVW1-t	MT20	4.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
N	729	0	729	0	0	5-8	5-8
H	729	0	729	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
N	513	350 / 0	0 / 0	0 / 0	0 / 0	163 / 0	0 / 0	
H	513	350 / 0	0 / 0	0 / 0	0 / 0	163 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00	C-K	-211 / 0	0.07 (1)
B-C	-847 / 0	-91.8	-91.8 0.14 (1)	6.25	K-D	0 / 229	0.05 (1)
C-D	-447 / 0	-91.8	-91.8 0.18 (1)	6.25	K-E	-210 / 0	0.07 (1)
D-E	-447 / 0	-91.8	-91.8 0.18 (1)	6.25	N-L	-26 / 0	0.00 (1)
E-F	-846 / 0	-91.8	-91.8 0.14 (1)	6.25	B-L	0 / 527	0.12 (1)
F-G	0 / 41	-91.8	-91.8 0.13 (1)	10.00	J-F	0 / 528	0.12 (1)
N-B	-701 / 0	0.0	0.0 0.07 (1)	7.81	J-H	-26 / 0	0.00 (1)
H-F	-701 / 0	0.0	0.0 0.07 (1)	7.81			
N-M	0 / 20	-18.5	-18.5 0.01 (4)	10.00			
M-L	0 / 14	0.0	0.0 0.03 (1)	10.00			
L-C	-92 / 2	0.0	0.0 0.02 (1)	7.81			
L-K	0 / 528	-18.5	-18.5 0.13 (1)	10.00			
K-J	0 / 527	-18.5	-18.5 0.13 (1)	10.00			
I-J	0 / 14	0.0	0.0 0.03 (1)	10.00			
J-E	-93 / 2	0.0	0.0 0.02 (1)	7.81			
I-H	0 / 20	-18.5	-18.5 0.01 (4)	10.00			

TOTAL WEIGHT = 2 X 56 = 112 LB

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

85% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.36")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.36")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.19/1.00 (C-D:1), BC=0.13/1.00 (K-L:1), WB=0.12/1.00 (B-L:1), SSI=0.13/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PS)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1867 788 1997 1856	

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.74 (F) (INPUT = 0.90)
JSI METAL = 0.20 (F) (INPUT = 1.00)



Structural component only
DWG# T-2007073

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408150	T11	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

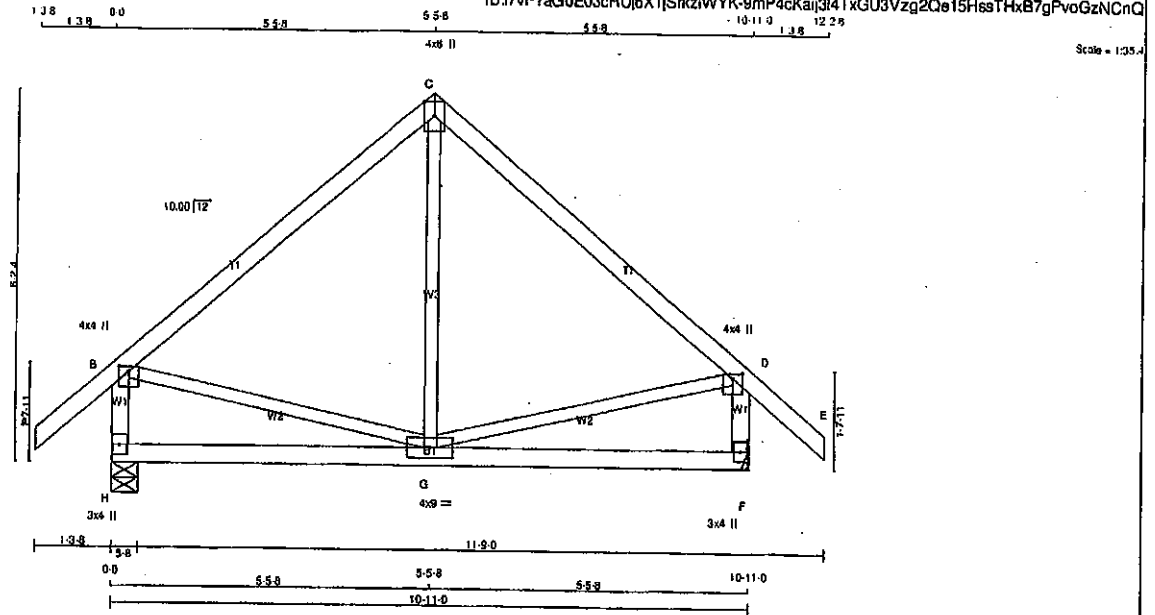

LUMBER			
N. L. G. A. RULES	SIZE	DRY	NO.2
CHORDS			
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
F - D	2x4	DRY	No.2
H - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00
C ITW+p	MT20	4.0	6.0	Edge	
D TMVW+p	MT20	4.0	4.0	1.00	2.00
F BMV1+p	MT20	3.0	4.0		
G BMVWW-t	MT20	4.0	9.0		
H BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REQD
JT	VERT	HORZ	DOWN	HORZ
H	729	0	729	0
F	729	0	729	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	513	350 / 0	0 / 0	0 / 0	0 / 0	0 / 0	163 / 0	0 / 0
F	513	350 / 0	0 / 0	0 / 0	0 / 0	0 / 0	163 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORZ. LOAD (LC1)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORZ. LOAD (LC1)
FR-TO				FR-TO			
A-B	0 / 41	-91.8	-91.8 0.13 (1)	G-C	-15 / 89	0.03 (4)	0.07 (1)
B-C	-380 / 0	-91.8	-91.8 0.35 (1)	B-G	0 / 300	0.07 (1)	0.07 (1)
C-D	-380 / 0	-91.8	-91.8 0.35 (1)	G-D	0 / 300	0.07 (1)	0.07 (1)
D-E	0 / 41	-91.8	-91.8 0.13 (1)				
H-B	-690 / 0	0.0	0.0 0.07 (1)				
F-D	-690 / 0	0.0	0.0 0.07 (1)				
H-G	0 / 0	-18.5	-18.5 0.16 (4)				
G-F	0 / 0	-18.5	-18.5 0.16 (4)				

TOTAL WEIGHT = 49 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, NBC 2012, ABC 2010
- PART 9 OF NBC 2012 (2018 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIG 2011, TPIG 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.36")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.36")
CALCULATED VERT. DEFL. (TL) = L/999 (0.02")

CSK TC=0.35/1.00 (B-C:1), BC=0.16/1.00 (G-H:4), WB=0.07/1.00 (D-G:1), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.82 (D) (INPUT = 0.90)
JSI METAL = 0.17 (D) (INPUT = 1.00)

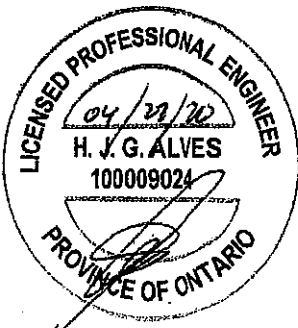


Structural component only
DWG# T-2007074

JOB NAME 408150	TRUSS NAME T12	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 26 11:03:01 2020 Page 1
ID:4NxGft_xHSHnstgnSWZu6izNuP6-59Xq1?cyEg?oIFQsAw?88qjPP4ZbxCqUb_u0s8zNCnO

Scale = 1:32.5

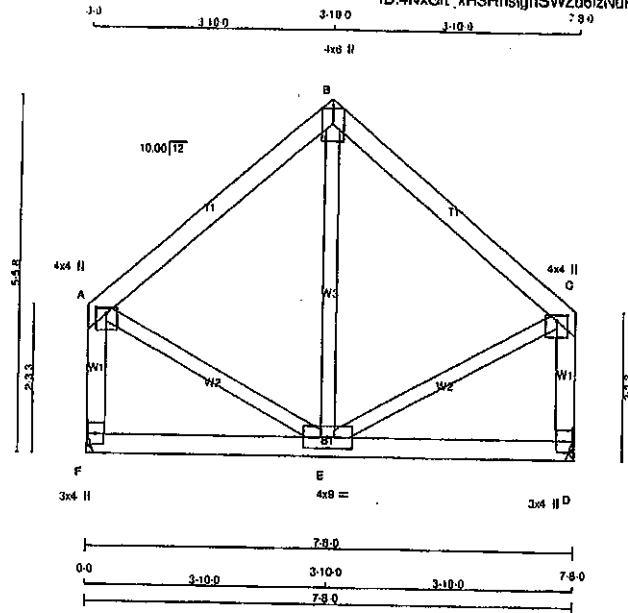

LUMBER				DESCR	
N. L. G. A. RULES	SIZE	LUMBER		SPF	
CHORDS					
A - B	2x4	DRY	No.2	SPF	
B - C	2x4	DRY	No.2	SPF	
F - A	2x4	DRY	No.2	SPF	
D - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW+p	MT20	4.0	4.0	1.00 2.00
B	TTW+p	MT20	4.0	6.0	Edge
C	TMVW+p	MT20	4.0	4.0	1.00 2.00
D	BMV1+p	MT20	3.0	4.0	
E	BMVWW-I	MT20	4.0	9.0	
F	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
F	423	0	423	0	0
D	423	0	423	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F, D. MINIMUM BEARING LENGTH AT JOINT F = 1-8, JOINT D = 1-8.

UNFACTORED REACTIONS		1ST CASE	MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
F	299	196 / 0	0 / 0	0 / 0	0 / 0	103 / 0	0 / 0	
D	299	196 / 0	0 / 0	0 / 0	0 / 0	103 / 0	0 / 0	

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED	FACTORED	MEMB.	WEBS	MAX. FACTORED	MEMB.	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX (PLF)	CS (LC)	UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX (LC)
FR-TO						FR-TO		
A-B	-214 / 0	-91.8	-91.8	0.17 (1)	6.25	E-B	-78 / 37	0.03 (1)
B-C	-214 / 0	-91.8	-91.8	0.17 (1)	6.25	A-E	0 / 184	0.04 (1)
F-A	-395 / 0	0.0	0.0	0.05 (1)	7.81	E-C	0 / 184	0.04 (1)
D-C	-395 / 0	0.0	0.0	0.05 (1)	7.81			
F-E	0 / 0	-18.5	-18.5	0.08 (4)	10.00			
E-D	0 / 0	-18.5	-18.5	0.08 (4)	10.00			

TOTAL WEIGHT = 35 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.26")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.26")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.17/1.00 (B-C:1), BC=0.08/1.00 (D-E:1), WB=0.04/1.00 (A-E:1), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.31 (C) (INPUT = 0.90)
JSI METAL= 0.09 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007075


JOB NAME 408150	TRUSS NAME T12S	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	----------

Tamareck Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:03:02 2020 Page 1

ID:4NxGft xHSHnsgnSWZu6izNuP6-ZL5CELda? 7IKP?3kwNng3GbiUw7gacq9dZObzNCnN

Scale = 1/2" = 1'-0"

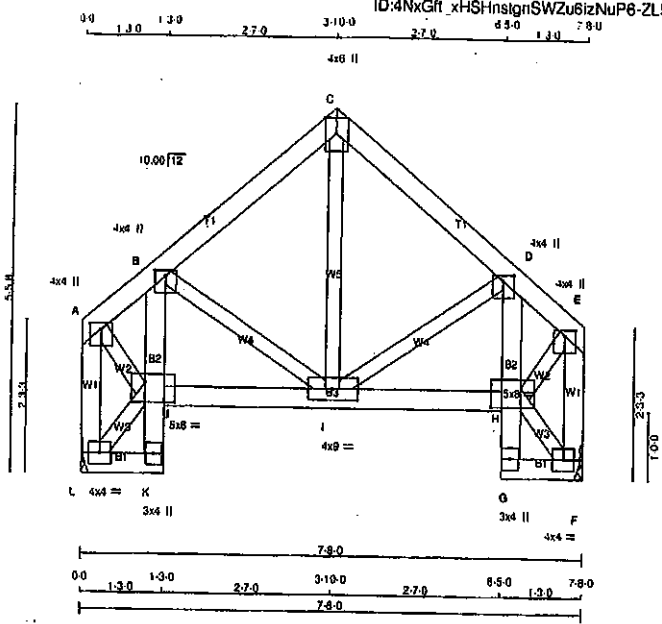

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF		
C - E	2x4 DRY	No.2	SPF		
L - A	2x4 DRY	No.2	SPF		
F - E	2x4 DRY	No.2	SPF		
L - K	2x4 DRY	No.2	SPF		
K - B	2x4 DRY	No.2	SPF		
J - H	2x4 DRY	No.2	SPF		
G - D	2x4 DRY	No.2	SPF		
G - F	2x4 DRY	No.2	SPF		
ALL WEBS	2x3 DRY	No.2	SPF		
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT	TYPE	PLATES	W	LEN	Y	X
A, B, D, E							
A - TMVW+p	MT20	4.0	4.0	1.00	2.00		
C - TTW+p	MT20	4.0	6.0	Edge			
F - BMVW1-i	MT20	4.0	4.0				
G - BMV+p	MT20	3.0	4.0				
H - BMVWW-i	MT20	5.0	8.0	3.50	5.50		
I - BMVWW-i	MT20	4.0	9.0				
J - BMVWW-i	MT20	5.0	8.0	3.50	5.50		
K - BMV+p	MT20	3.0	4.0				
L - BMVW1-i	MT20	4.0	4.0				

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT	REQD
	GROSS REACTION		GROSS REACTION			BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
L	423	0	423	0	0	MECHANICAL	
F	423	0	423	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT L, F. MINIMUM BEARING LENGTH AT JOINT L = 1-8, JOINT F = 1-8.

UNFACTORED REACTIONS							
1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
L	299	196 / 0	0 / 0	0 / 0	0 / 0	103 / 0	0 / 0
F	299	198 / 0	0 / 0	0 / 0	0 / 0	103 / 0	0 / 0

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM TO			FR-TO			
A-B	-282 / 0	-91.8	-91.8	0.08 (1)	6.25	I-C	0 / 125	0.03 (1)
B-C	-274 / 0	-91.8	-91.8	0.07 (1)	6.25	I-D	-57 / 0	0.01 (1)
C-D	-274 / 0	-91.8	-91.8	0.07 (1)	6.25	B-I	-57 / 0	0.01 (1)
D-E	-282 / 0	-91.8	-91.8	0.08 (1)	6.25	L-J	-13 / 0	0.00 (1)
L-A	-404 / 0	0.0	0.0	0.05 (1)	7.81	A-J	0 / 317	0.07 (1)
F-E	-404 / 0	0.0	0.0	0.05 (1)	7.81	H-F	-13 / 0	0.00 (1)
						H-E	0 / 317	0.07 (1)
L-K	0 / 9	-18.5	-18.5	0.01 (4)	10.00			
K-J	0 / 11	0.0	0.0	0.01 (1)	10.00			
J-B	-182 / 0	0.0	0.0	0.01 (1)	7.81			
J-I	0 / 247	-18.5	-18.5	0.08 (1)	10.00			
I-H	0 / 247	-18.5	-18.5	0.08 (1)	10.00			
G-H	0 / 11	0.0	0.0	0.01 (1)	10.00			
H-D	-182 / 0	0.0	0.0	0.01 (1)	7.81			
G-F	0 / 9	-18.5	-18.5	0.01 (4)	10.00			

TOTAL WEIGHT = 2 X 43 = 85 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.26")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.26")
CALCULATED VERT. DEFL. (TL) = L/999 (0.01")

CSI: TC=0.07/1.00 (C-D:1), BC=0.06/1.00 (H-I:1), WB=0.07/1.00 (A-J:1), SS=0.09/1.00 (C-D:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.30 (E) (INPUT = 0.60)
JSI METAL= 0.08 (E) (INPUT = 1.00)

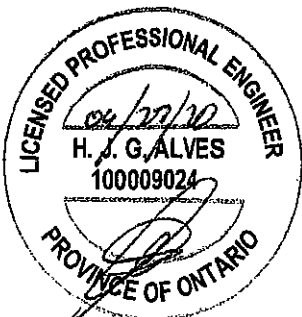

Structural component only
DWG# T-2007076

JOB NAME 408150	TRUSS NAME T15	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310.5 Oct 29 2019 M7ek Industries, Inc. Sat Apr 25 11:33:33 2020 Page 1	
				ID:17vF7aG0E03cRUj6X1jSkzWYK-1XibSheCmFWyZaFIL1cDGpbHuDpP_en2IN7x1zNCnM	
				10/10/10 10:11	
				Scale = 1:16.8	

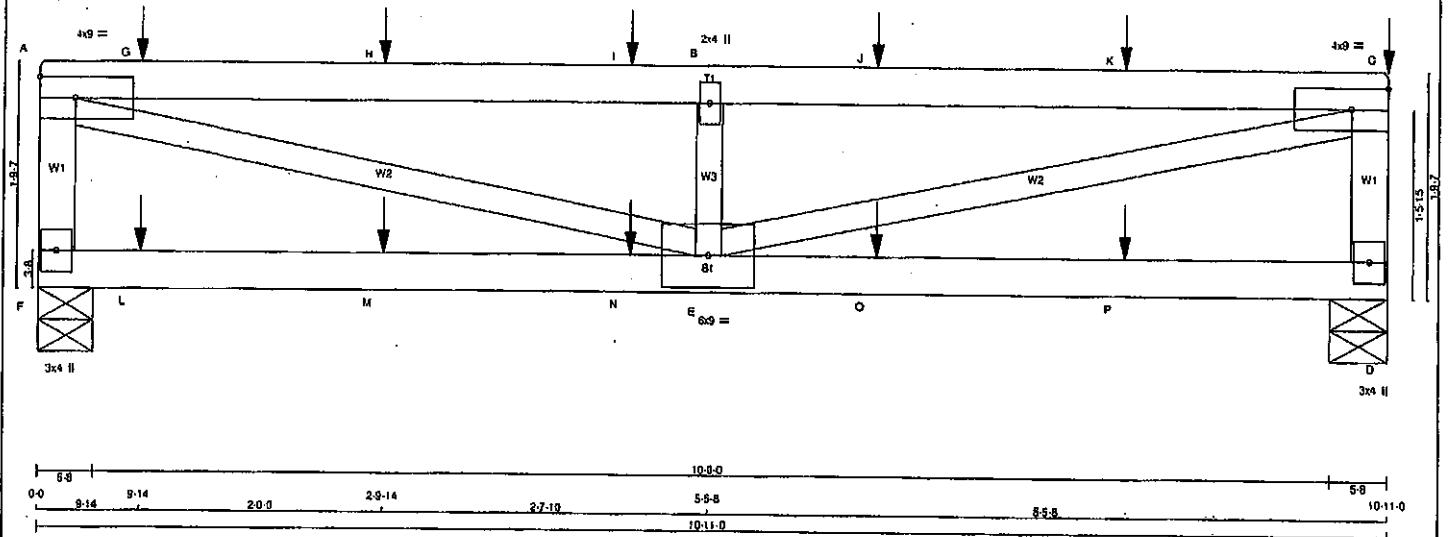

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
F - A	2x4	DRY No.2	SPF
D - C	2x4	DRY No.2	SPF
F - D	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	4.0	9.0	Edge
B	TMVW-4	MT20	2.0	4.0	
C	TMVW-4	MT20	4.0	9.0	Edge
D	BMV1+4	MT20	3.0	4.0	
E	BMVWW-1	MT20	6.0	9.0	
F	BMV1+4	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX
F	976	0	976	0	5-8	5-8
D	1015	0	1015	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LOASE COMBINED		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	SNOW	LIVE	PERM	LIVE			
F	690	453 / 0	0 / 0	0 / 0	0 / 0	237 / 0	0 / 0
D	718	479 / 0	0 / 0	0 / 0	0 / 0	237 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.55 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LOC 1	MAX CSI (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM	TO		LENGTH	FR-TO			
A-G	-2081 / 0	-91.8	-91.8	0.79 (1)	3.55	A-E	0 / 2157	0.53 (1)	
G-H	-2081 / 0	-91.8	-91.8	0.79 (1)	3.55	E-B	-876 / 0	0.14 (1)	
H-I	-2081 / 0	-91.8	-91.8	0.79 (1)	3.55	E-C	0 / 2157	0.53 (1)	
I-B	-2081 / 0	-91.8	-91.8	0.79 (1)	3.55				
B-J	-2081 / 0	-91.8	-91.8	0.79 (1)	3.55				
J-K	-2081 / 0	-91.8	-91.8	0.79 (1)	3.55				
K-C	-2081 / 0	-91.8	-91.8	0.79 (1)	3.55				
F-A	-889 / 0	0.0	0.0	0.10 (1)	7.81				
D-C	-938 / 0	0.0	0.0	0.11 (1)	7.81				
F-L	0 / 0	-18.5	-18.5	0.22 (4)	10.00				
L-M	0 / 0	-18.5	-18.5	0.22 (4)	10.00				
M-N	0 / 0	-18.5	-18.5	0.22 (4)	10.00				
N-E	0 / 0	-18.5	-18.5	0.22 (4)	10.00				
E-O	0 / 0	-18.5	-18.5	0.22 (4)	10.00				
O-P	0 / 0	-18.5	-18.5	0.22 (4)	10.00				
P-D	0 / 0	-18.5	-18.5	0.22 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC	LC1	MAX	FACE	DIR.	TYPE	HEEL	CONN.
C	10-11-0	-123	-123	---	BACK	VERT	TOTAL	---
G	9-14	-90	-90	---	BACK	VERT	TOTAL	---
H	2-9-14	-82	-82	---	BACK	VERT	TOTAL	---
I	4-9-14	-82	-82	---	BACK	VERT	TOTAL	---
J	6-9-14	-82	-82	---	BACK	VERT	TOTAL	---
K	8-9-14	-82	-82	---	BACK	VERT	TOTAL	---
L	9-14	-51	-51	---	BACK	VERT	TOTAL	---
M	2-9-14	-49	-49	---	BACK	VERT	TOTAL	---
N	4-9-14	-49	-49	---	BACK	VERT	TOTAL	---
O	6-9-14	-49	-49	---	BACK	VERT	TOTAL	---
P	8-9-14	-49	-49	---	BACK	VERT	TOTAL	---

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.0/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.36")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.08")
ALLOWABLE DEFL.(TL) = $L/360$ (0.36")
CALCULATED VERT. DEFL.(TL) = $L/617$ (0.16")

CSI: TC=0.79/1.00 (A-B:1), BC=0.22/1.00 (E-F:4), WB=0.53/1.00 (A-E:1), SS=0.39/1.00 (A-B:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PS)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1667 788 1957 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (A) (INPUT = 0.90)
JSI METAL= 0.40 (E) (INPUT = 1.00)

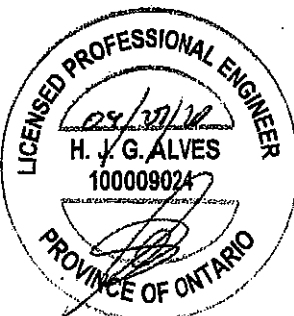

Structural component only
DWG# T-2007077

[illegible]

TOTAL WEIGHT = 2 X 183 = 365 lb

[M]

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***

GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.

LOADS WERE DERIVED FROM USER INPUT

NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL =	25.8	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 6.00/12

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL
LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = U/999 (0.20")
 ALLOWABLE DEFL.(TL)= L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = U/999 (0.36")

CSI: TC=0.42/1.00 (D-E:1), SC=0.32/1.00 (C-Q:1),
 WB=0.56/1.00 (C-Q:1), SS=0.22/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT
RESPONSIBLE FOR QUALITY CONTROL IN THE
TRUSS MANUFACTURING PLANT .

NAIL VALUES		SHEAR		SECTION	
PLATE	GRIP(DRY)	(PSI)	(FLI)	(FLI)	
	MAX MIN	MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1667 788	1887 1656		

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.82 (M) (INPUT = 0.90)

JSI METAL= 0.52 (P) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408151	T20	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 MATEK Industries, Inc. Sat Apr 25 11:19:44 2020 Page 2
ID:h2dfigC44wS E2tzqPs atzilRw-E6e?Xzj51rNUYObeR4VLHmmlPOqOS/27EXMbZWzNCX

PLATES (table in inches)	W	LEN	Y	X
JT TYPE PLATES				
B TMWV+p MT20	7.0	8.0		
C TTWW+m MT20	8.0	9.0	3.50	1.75
D TMWW-l MT20	5.0	8.0	2.50	2.50
E TMW+w MT20	3.0	8.0		
F TS-l MT20	5.0	8.0		
G TMWW-l MT20	5.0	8.0	2.50	2.50
H TTWW+m MT20	8.0	9.0	3.50	1.75
I TMWV+p MT20	7.0	8.0		
K BMV-l+p MT20	3.0	8.0		
L BMWW-l MT20	5.0	8.0	2.50	2.25
M BMWW-l MT20	5.0	8.0	2.50	3.00
N BS-l MT20	8.0	9.0		
O BMWWV-l MT20	5.0	12.0		
P BS-l MT20	8.0	9.0		
Q BMWW-l MT20	5.0	8.0	2.50	3.00
R BMWW-l MT20	5.0	8.0	2.50	2.25
S BMV-l+p MT20	3.0	8.0		

LOADING

TOTAL LOAD CASES: (4)


CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	LC1 MAX (PLF)	MAX. UNBRAC LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO							
M-AS	0 / 2578	-18.5	-18.5	0.18 (1)	10.00		
AS-AT	0 / 2578	-18.5	-18.5	0.18 (1)	10.00		
AT-AU	0 / 2578	-18.5	-18.5	0.18 (1)	10.00		
AU-L	0 / 2578	-18.5	-18.5	0.18 (1)	10.00		
L-AV	0 / 0	-18.5	-18.5	0.08 (4)	10.00		
AV-K	0 / 0	-18.5	-18.5	0.08 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	2-11-8	-38	-42	---	FRONT	VERT	DEAD	---	C1
H	32-2-8	-38	-42	---	FRONT	VERT	SNOW	---	C1
H	32-2-8	-118	-118	---	FRONT	VERT	DEAD	---	C1
H	32-2-8	-191	-191	---	FRONT	VERT	TOTAL	---	C1
L	31-11-4	-28	-28	---	FRONT	VERT	SNOW	---	C1
P	11-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
T	3-11-4	-111	-111	---	FRONT	VERT	TOTAL	---	C1
U	5-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	17-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	19-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	21-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	23-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	25-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	27-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AG	29-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AH	1-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AI	3-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AJ	5-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AK	7-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AL	9-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AM	13-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AN	15-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AO	17-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AP	19-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AQ	21-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AR	23-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AS	25-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AT	27-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AU	29-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AV	33-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1


CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

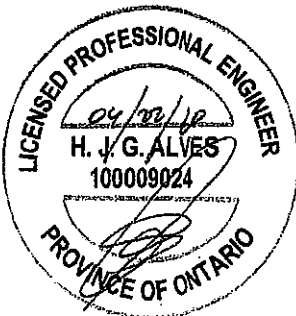

Structural component only
DWG# T-2007081 3/1

JOB NAME 408151	TRUSS NAME T20Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:19:45 2020 Page 1	
ID:h2dlgC44wS E2t2qPs alziIRw-JCOLmko9VL9YAq n0aqaJuZ04EB5KGTB585yzNCX				Scale = 1:37.3	

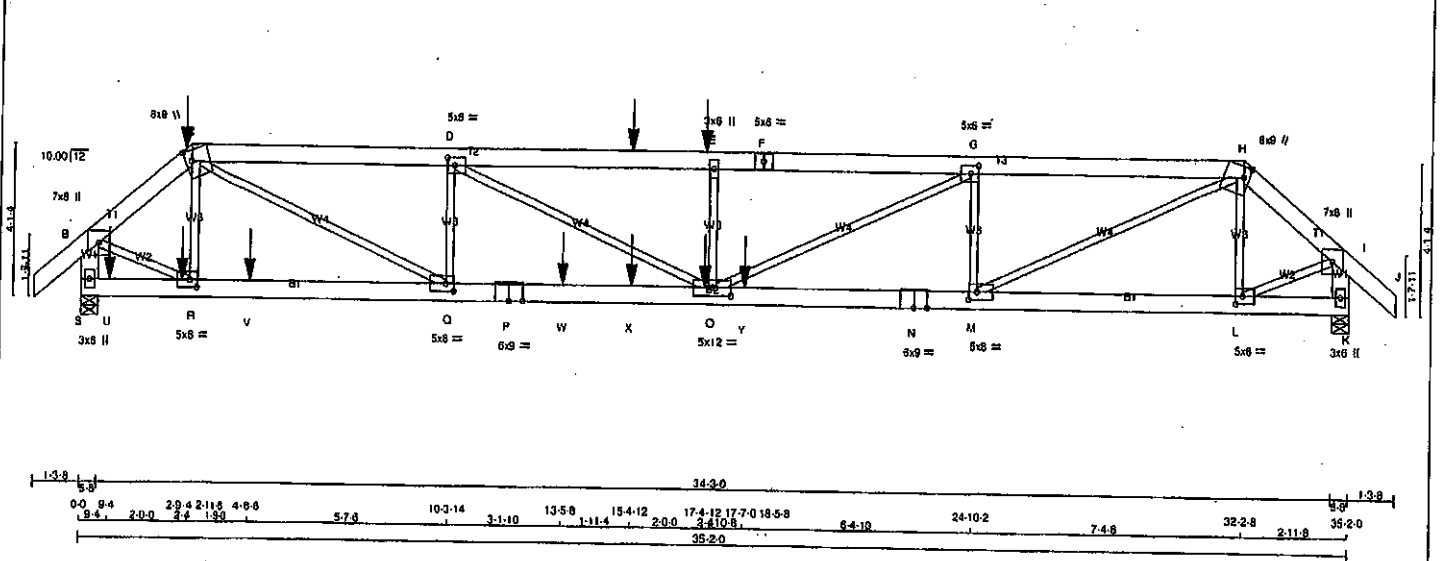

LUMBER	N.L.G.A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x8	DRY	No.2	SPF		
C - F	2x8	DRY	No.2	SPF		
F - H	2x8	DRY	No.2	SPF		
H - J	2x8	DRY	No.2	SPF		
S - B	2x8	DRY	No.2	SPF		
K - I	2x8	DRY	No.2	SPF		
S - P	2x8	DRY	1650F 1.5E	SPF		
P - N	2x8	DRY	1650F 1.5E	SPF		
N - K	2x8	DRY	1650F 1.5E	SPF		
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS	#ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS			
A - C	2	12	SIDE(122.0)
C - F	2	12	SIDE(183.1)
F - H	2	12	TOP
H - J	2	12	TOP
S - B	2	12	TOP
K - I	2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS			
S - P	2	12	SIDE(183.1)
P - N	2	12	SIDE(183.1)
N - K	2	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS			
2x3	1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	DOWN	HORIZ	UPLIFT	BRG	IN-SX	BRG	IN-SX
S	4991	0	4991	0	0	5-8	5-8	5-8	5-8
K	3694	0	3694	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE	2ND CASE	3RD CASE	4TH CASE	5TH CASE	6TH CASE	7TH CASE	8TH CASE	9TH CASE	10TH CASE
S	3528	2923 / 0	0 / 0	0 / 0	0 / 0	0 / 0	1206 / 0	0 / 0	0 / 0	0 / 0
K	2808	1737 / 0	0 / 0	0 / 0	0 / 0	0 / 0	871 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.20 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO										
A-B	0 / 42	-91.8	-91.8	0.04 (1)	10.00	R-C	-253 / 44	0.03 (1)		
B-C	-5342 / 0	-91.8	-91.8	0.07 (1)	5.02	C-Q	0 / 8569	0.81 (1)		
C-D	-9971 / 0	-91.8	-91.8	0.39 (1)	3.64	D-O	-1958 / 0	0.23 (1)		
D-T	-12379 / 0	-91.8	-91.8	0.52 (1)	3.20	O-D	0 / 2694	0.33 (1)		
E-F	-12379 / 0	-91.8	-91.8	0.52 (1)	3.20	O-E	-782 / 0	0.09 (1)		
F-G	-12379 / 0	-91.8	-91.8	0.49 (1)	3.23	G-O	0 / 4229	0.52 (1)		
G-H	-8599 / 0	-91.8	-91.8	0.33 (1)	3.93	M-G	-2619 / 0	0.31 (1)		
H-I	-3750 / 0	-91.8	-91.8	0.06 (1)	5.79	L-H	-864 / 0	0.10 (1)		
I-J	0 / 42	-91.8	-91.8	0.04 (1)	10.00	B-R	0 / 4341	0.54 (1)		
S-B	-5197 / 0	0.0	0.0	0.19 (1)	6.41	L-I	0 / 3047	0.38 (1)		
K-I	-3727 / 0	0.0	0.0	0.13 (1)	7.30					
S-U	0 / 0	-18.5	-18.5	0.20 (1)	10.00					
U-R	0 / 0	-18.5	-18.5	0.20 (1)	10.00					
R-V	0 / 4073	-18.5	-18.5	0.36 (1)	10.00					
V-Q	0 / 4073	-18.5	-18.5	0.36 (1)	10.00					
Q-P	0 / 9371	-18.5	-18.5	0.73 (1)	10.00					
P-W	0 / 9371	-18.5	-18.5	0.73 (1)	10.00					
W-X	0 / 9371	-18.5	-18.5	0.73 (1)	10.00					
X-O	0 / 9371	-18.5	-18.5	0.73 (1)	10.00					
O-Y	0 / 8600	-18.5	-18.5	0.58 (1)	10.00					
Y-N	0 / 8600	-18.5	-18.5	0.58 (1)	10.00					
N-M	0 / 8600	-18.5	-18.5	0.58 (1)	10.00					
M-L	0 / 2839	-18.5	-18.5	0.18 (1)	10.00					
L-K	0 / 0	-18.5	-18.5	0.05 (1)	10.00					

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	2-11-8	-38	-42	---	FRONT	VERT	DEAD	---	C1
C	2-11-8	-117	-117	---	BACK	VERT	TOTAL	---	C1
C	2-11-8	-191	-191	---	FRONT	VERT	SNOW	---	C1
E	17-4-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
O	17-4-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
R	2-9-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
T	15-4-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
U	9-1	-29	-29	---	BACK	VERT	TOTAL	---	C1
V	4-8-8	-1068	-1068	---	BACK	VERT	TOTAL	---	C1
W	13-5-8	-1068	-1068	---	BACK	VERT	TOTAL	---	C1
X	15-4-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
Y	18-5-8	-1738	-1738	---	BACK	VERT	TOTAL	---	C1

TOTAL WEIGHT = 2 X 183 = 365 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = U/998 (0.33")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = U/685 (0.62")

CS: TC=0.52/1.00 (D-E:1), BC=0.73/1.00 (O-Q:1), WB=0.81/1.00 (C-Q:1), SS=0.57/1.00 (M-O:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (D) (INPUT = 0.90)
JSI METAL = 0.84 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007082 1/2


CONTINUED ON PAGE 2

JOB NAME 408151	TRUSS NAME T20Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 11:19:45 2020 Page 2 ID:h2dfIqC44wS E2tzaPs_atzIIrw-tICOLmk09VL9YAq n0agaJuZo4E85KGTB585yzNCX	

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	7.0	8.0	
C	TTWW+m	MT20	8.0	9.0	3.50 1.75
D	TMWW-t	MT20	5.0	8.0	2.50 2.50
E	TMW+w	MT20	3.0	8.0	
F	TS-t	MT20	5.0	6.0	
G	TMWW-t	MT20	5.0	8.0	2.50 2.50
H	TTWW+m	MT20	8.0	9.0	3.50 1.75
I	TMVW+p	MT20	7.0	8.0	
K	BMV1+p	MT20	3.0	6.0	
L	BMWW-t	MT20	5.0	6.0	2.50 2.25
M	BMWW-t	MT20	5.0	8.0	2.50 2.75
N	BS-t	MT20	6.0	9.0	
O	BMWWW-t	MT20	5.0	12.0	2.75 8.00
P	BS-t	MT20	8.0	9.0	
Q	BMWW-t	MT20	5.0	8.0	2.50 2.75
R	BMWW-t	MT20	5.0	6.0	2.50 2.25
S	BMV1+p	MT20	3.0	6.0	

CONNECTION REQUIREMENTS


1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

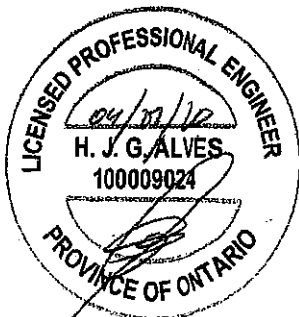

Structural component only
DWG# T-2007082 7/2

JOB NAME 408151	TRUSS NAME T21	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:19:48 2020 Page 1
 ID:h2dlqC44wS_E2tqPs_atzIRw-AVImYmMZTdCniiOYUXpMnr1ECRIweZOhridOzNCXh
 1.3-8 0.0 4.1-14 4.1-14 5.5-3 9.7-1 14-11.0 20.3-0 25.2-0 31.0-2 35.2-0 35.2-0
 Scale = 1:57.3

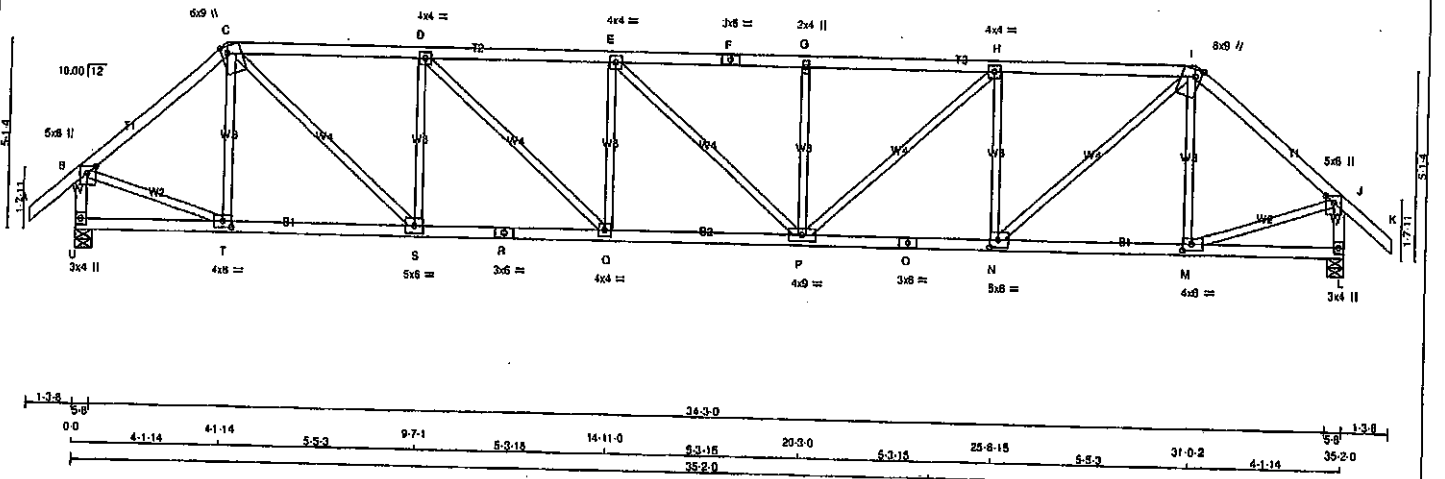

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
I - K	2x4	DRY	No.2	SPF
U - B	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
U - R	2x4	DRY	No.2	SPF
R - O	2x4	DRY	No.2	SPF
O - L	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	5.0	8.0	Edge 2.75	
C TTWW+m	MT20	6.0	9.0	Edge 1.75	
D, E, H					
D TMVW-l	MT20	4.0	4.0		
F TS-l	MT20	3.0	8.0		
G TMVW+w	MT20	2.0	4.0		
I TTWW+m	MT20	6.0	8.0	Edge 1.75	
J TMVW+p	MT20	5.0	8.0	Edge 2.75	
L BMV1+p	MT20	3.0	4.0		
M BMVW-l	MT20	4.0	8.0	2.00 2.75	
N BMVW-l	MT20	5.0	8.0	2.50 2.75	
O BS-l	MT20	3.0	6.0		
P BMVW+l	MT20	4.0	9.0		
Q BMVW-l	MT20	4.0	4.0		
R BS-l	MT20	3.0	6.0		
S BMVW-l	MT20	5.0	8.0		
T BMVW-l	MT20	4.0	8.0	2.00 2.75	
U BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
U	2088 0	2088 0	5-8	5-8
L	2088 0	2088 0	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
U	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.20 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 41	-91.8 -91.8 0.13 (1)	10.00	T-C	-358 / 0	0.14 (1)	
B-C	-1960 / 0	-91.8 -91.8 0.38 (1)	4.48	C-S	0 / 1836	0.41 (1)	
C-D	-2871 / 0	-91.8 -91.8 0.57 (1)	3.59	S-D	-1118 / 0	0.43 (1)	
D-E	-3506 / 0	-91.8 -91.8 0.65 (1)	3.21	D-Q	0 / 856	0.19 (1)	
E-F	-3506 / 0	-91.8 -91.8 0.53 (1)	3.36	Q-E	-475 / 0	0.18 (1)	
F-G	-3506 / 0	-91.8 -91.8 0.69 (1)	3.20	E-P	-2 / 0	0.00 (1)	
G-H	-3506 / 0	-91.8 -91.8 0.69 (1)	3.20	P-G	-474 / 0	0.18 (1)	
H-I	-2871 / 0	-91.8 -91.8 0.57 (1)	3.59	P-H	0 / 853	0.19 (1)	
I-J	-1960 / 0	-91.8 -91.8 0.38 (1)	4.48	H-I	-1117 / 0	0.43 (1)	
J-K	0 / 41	-91.8 -91.8 0.13 (1)	10.00	N-I	0 / 1837	0.41 (1)	
U-B	-2037 / 0	0.0 0.0 0.22 (1)	5.92	M-I	-358 / 0	0.14 (1)	
L-J	-2037 / 0	0.0 0.0 0.22 (1)	5.92	B-T	0 / 1571	0.35 (1)	
				M-J	0 / 1571	0.35 (1)	
U-T	0 / 0	-18.5 -18.5 0.10 (4)	10.00				
T-S	0 / 1494	-18.5 -18.5 0.30 (1)	10.00				
S-R	0 / 2871	-18.5 -18.5 0.51 (1)	10.00				
R-Q	0 / 2871	-18.5 -18.5 0.51 (1)	10.00				
Q-P	0 / 3506	-18.5 -18.5 0.82 (1)	10.00				
P-O	0 / 2872	-18.5 -18.5 0.51 (1)	10.00				
O-N	0 / 2872	-18.5 -18.5 0.51 (1)	10.00				
N-M	0 / 1494	-18.5 -18.5 0.30 (1)	10.00				
M-L	0 / 0	-18.5 -18.5 0.10 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCG 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")

CALCULATED VERT. DEFL.(LL) = L/999 (0.20")

ALLOWABLE DEFL.(TL) = L/360 (1.17")

CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CSI: TC=0.66/1.00 (G-H:1), BC=0.62/1.00 (P-Q:1), WB=0.43/1.00 (D-S:1), SS=0.23/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES


PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1667 789	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (S) (INPUT = 0.90)


JSI METAL = 0.90 (O) (INPUT = 1.00)

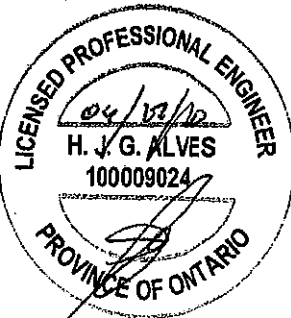

Structural component only
 DWG# T-2007083


JOB NAME 408151	TRUSS NAME T22	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:19:37 2020 Page 1
 ID:h2dlqC44wS_E2bzqPs_atzllRw-ehJ89?n_Km13PrkD6C22v?OAzopWf3vZwVaFArzNCXg
 138 0.0 54.3 54.5 52.0 114.4 80.12 177.0 58.12 237.12 299.11 54.5 352.0 385.8
 Scale = 1:57.4

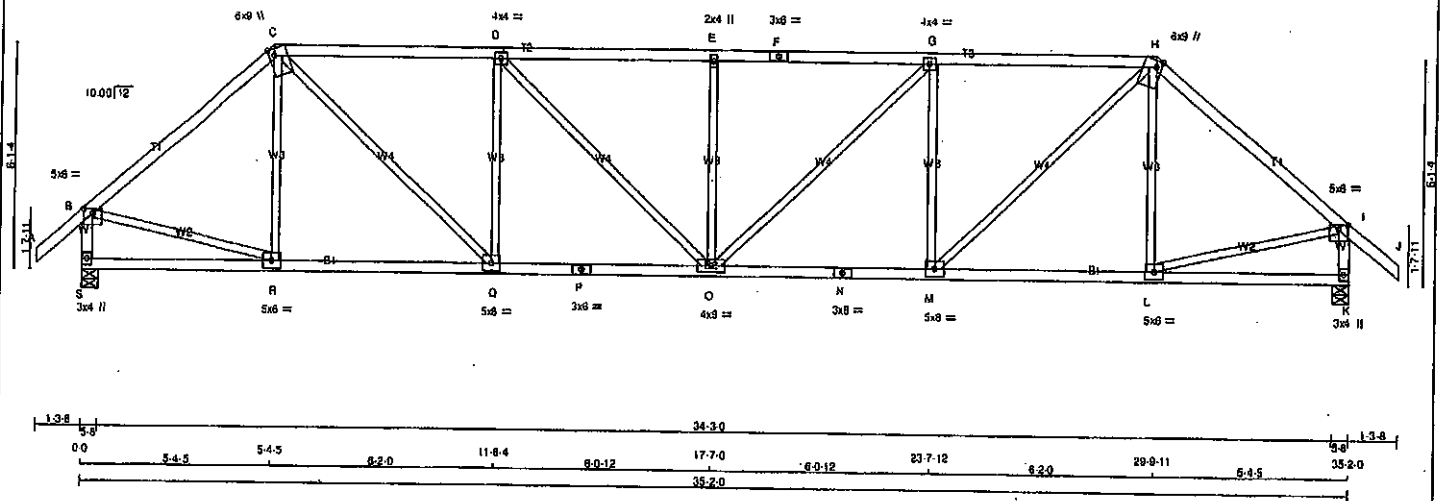


LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES				BEARINGS				SPECIFIED LOADS:			
CHORDS	SIZE	DRY	LUMBER	DESCR.	FACTORED	MAXIMUM FACTORED	INPUT	REQD	TOP CH. LL	LL	PSF
A - C	2x4	DRY	No.2	SPF	GROSS REACTION	GROSS REACTION	BRG	BRG	OL	LL	PSF
C - F	2x4	DRY	No.2	SPF	VERT	HORZ	DOWN	HORZ	DL	LL	PSF
F - H	2x4	DRY	No.2	SPF	JT	0	2088	0	DL	LL	PSF
H - J	2x4	DRY	No.2	SPF	S	0	2088	0	DL	LL	PSF
S - B	2x4	DRY	No.2	SPF	K	0	2088	0	DL	LL	PSF
K - I	2x4	DRY	No.2	SPF					DL	LL	PSF
S - P	2x4	DRY	No.2	SPF					DL	LL	PSF
P - N	2x4	DRY	No.2	SPF					DL	LL	PSF
N - K	2x4	DRY	No.2	SPF					DL	LL	PSF
ALL WEBS	2x3	DRY	No.2	SPF	UNFACTORED REACTIONS				TOTAL LOAD = 39.0 PSF		
EXCEPT					1ST CASE				SPACING = 24.0 IN. C/C		
					MAX/MIN COMPONENT REACTIONS				LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12		
					JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
					S	1458	971/0	0/0	0/0	0/0	488/0
					K	1458	971/0	0/0	0/0	0/0	488/0

DRY: SEASONED LUMBER.				BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K				THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015			
PLATES (table in inches)				BRACING				THIS DESIGN COMPLIES WITH:			
JT	TYPE	PLATES	W LEN Y X	TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.28 FT.				- PART 9 OF NBCC 2010, OBC 2012, ABC 2019			
B	TMWW-p	MT20	5.0 6.0 1.50 3.00	MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.				- PART 9 OF OBC 2012 (2019 AMENDMENT)			
C	TTWW-m	MT20	6.0 9.0 Edge 1.75	ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.				- CSA 088-09, CSA 086-14			
D	TMWW-l	MT20	4.0 4.0	LOADING				- TPIC 2011, TPIC 2014			
E	TMWW-w	MT20	2.0 4.0	TOTAL LOAD CASES: (4)				(65% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD			
F	TS-l	MT20	3.0 6.0	CHORDS				ALLOWABLE DEFL.(LL) = L/360 (1.17")			
G	TMWW-l	MT20	4.0 4.0	MEMB. MAX. FACTORED				CALCULATED VERT. DEFL.(LL) = L/999 (0.16")			
H	TTWW-m	MT20	6.0 9.0 Edge 1.75	VERT. LOAD LC1 MAX				ALLOWABLE DEFL.(TL) = L/360 (1.17")			
I	TMWW-p	MT20	5.0 6.0 1.50 3.00	CSI (LC)				CALCULATED VERT. DEFL.(TL) = L/999 (0.29")			
K	BMV-l-p	MT20	3.0 4.0	UNBRACED LENGTH				CSI TO=0.78/1.00 (D-E:1), BC=0.49/1.00 (O-Q:1)			
L, M, Q, R				FR-TO				WB=0.55/1.00 (G-M:1), SSI=0.27/1.00 (C-D:1)			
L	BMWW-l	MT20	5.0 6.0	MEMB. MAX. FACTORED				DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10			
N	BS-l	MT20	3.0 6.0	FORCE (LBS)				COMP=1.10 SHEAR=1.10 TENS=1.10			
O	BMWW-l	MT20	4.0 9.0	VERT. LOAD LC1 MAX				COMPANION LIVE LOAD FACTOR = 1.00			
P	BS-l	MT20	3.0 6.0	CSI (LC)				TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.			
S	BMV-l-p	MT20	3.0 4.0	UNBRACED LENGTH				NAIL VALUES			
				FR-TO				PLATE GRIP(DRY) SHEAR SECTION			
				MEMB. MAX. FACTORED				(PSI) (PL) (PL)			
				FORCE (LBS)				MAX MIN MAX MIN MAX MIN			
				CSI (LC)				MT20 .818 .354 .187 .788 .197 .185			
				UNBRACED LENGTH				PLATE PLACEMENT TOL. = 0.250 inches			
				FR-TO				PLATE ROTATION TOL. = 5.0 Deg.			
				MEMB. MAX. FACTORED				JSI GRIP= 0.90 (B) (INPUT = 0.90)			
				FORCE (LBS)				JSI METAL= 0.85 (N) (INPUT = 1.00)			
				CSI (LC)							

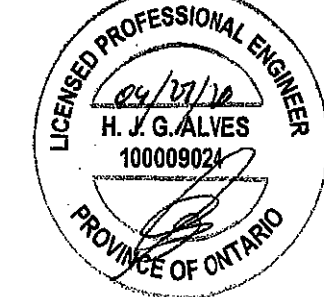

Structural component only
 DWG# T-2007084

JOB NAME 408151	TRUSS NAME T23	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

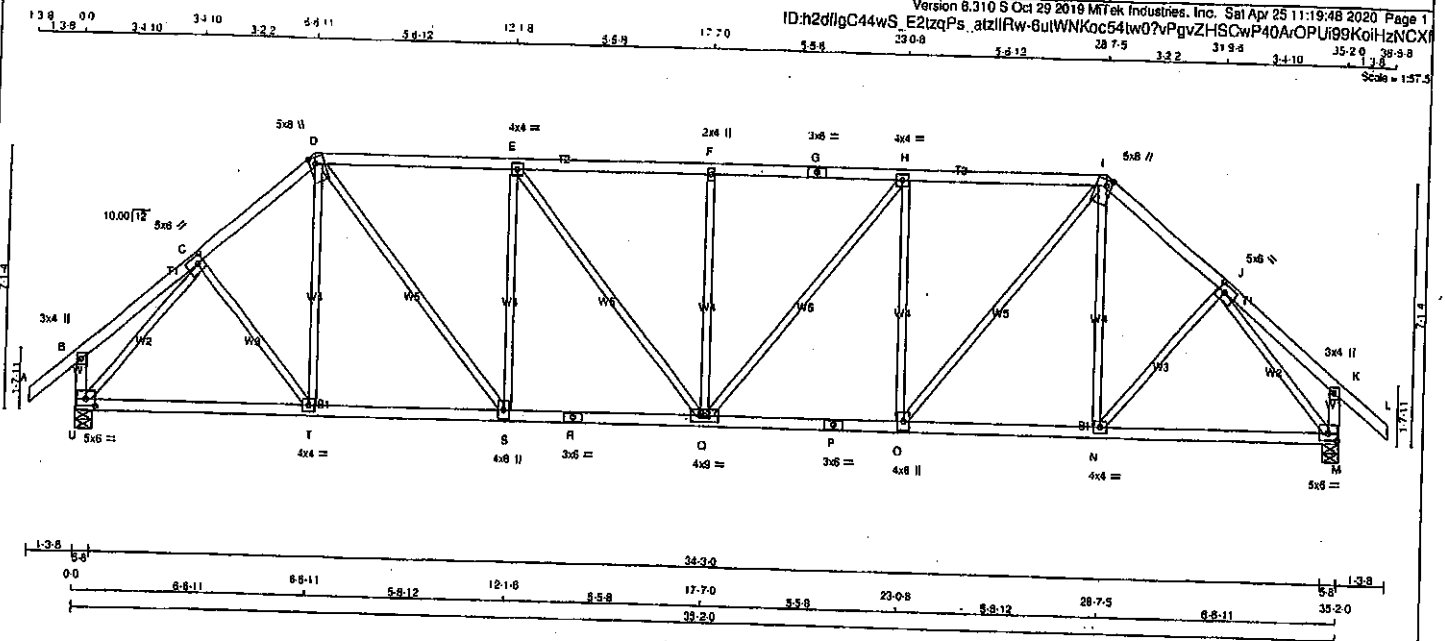

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - G	2x4	DRY No.2	SPF
G - I	2x4	DRY No.2	SPF
I - L	2x4	DRY No.2	SPF
U - B	2x4	DRY No.2	SPF
M - K	2x4	DRY No.2	SPF
U - R	2x4	DRY No.2	SPF
R - P	2x4	DRY No.2	SPF
P - M	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWV+1	MT20	5.0	6.0	2.50	2.25
D	TTWV+m	MT20	5.0	8.0	2.00	1.75
E	TMWV+1	MT20	4.0	4.0		
F	TMW+w	MT20	2.0	4.0		
G	TS+1	MT20	3.0	6.0		
H	TMWV+1	MT20	4.0	4.0		
I	TMWV+m	MT20	5.0	8.0	2.00	1.75
J	TMWV+1	MT20	5.0	6.0	2.50	2.25
K	TMV+o	MT20	3.0	4.0		
M	BMWV+1	MT20	5.0	6.0	2.25	3.00
N	BMWV+1	MT20	4.0	4.0		
O	BMWV+1	MT20	4.0	8.0		
P	BS+1	MT20	3.0	6.0		
Q	BMWV+1	MT20	4.0	9.0		
R	BS+1	MT20	3.0	6.0		
S	BMWV+1	MT20	4.0	6.0		
T	BMWV+1	MT20	4.0	4.0		
U	BMWV+1	MT20	5.0	6.0	2.25	3.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	UP	IN-SX
U	2068	0	0	5-8
M	2068	0	0	5-8

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
U	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0	0 / 0
M	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED (PLF)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED (PLF)	
FR-TO				FR-TO			
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00	C-T	0 / 156	0.04 (1)
B-C	0 / 19	-91.8	-91.8 0.14 (1)	10.00	T-D	0 / 78	0.03 (4)
C-D	-2023 / 0	-91.8	-91.8 0.20 (1)	4.59	D-S	0 / 1220	0.27 (1)
D-E	-2308 / 0	-91.8	-91.8 0.55 (1)	3.94	S-E	-850 / 0	0.74 (1)
E-F	-2534 / 0	-91.8	-91.8 0.57 (1)	3.77	E-Q	0 / 361	0.08 (1)
F-G	-2534 / 0	-91.8	-91.8 0.57 (1)	3.77	Q-H	-461 / 0	0.40 (1)
G-H	-2534 / 0	-91.8	-91.8 0.57 (1)	3.77	H-I	0 / 361	0.08 (1)
H-I	-2308 / 0	-91.8	-91.8 0.55 (1)	3.94	I-J	-850 / 0	0.74 (1)
I-J	-2023 / 0	-91.8	-91.8 0.20 (1)	4.59	J-K	0 / 1220	0.27 (1)
J-K	0 / 19	-91.8	-91.8 0.14 (1)	10.00	K-L	0 / 78	0.03 (4)
K-L	0 / 41	-91.8	-91.8 0.13 (1)	10.00	L-M	0 / 156	0.04 (1)
U-B	-245 / 0	0.0	0.0 0.03 (1)	7.81	U-C	-2277 / 0	0.88 (1)
M-K	-245 / 0	0.0	0.0 0.03 (1)	7.81	J-M	-2277 / 0	0.98 (1)
U-T	0 / 1433	-18.5	-18.5 0.33 (1)	10.00			
T-S	0 / 1535	-18.5	-18.5 0.35 (1)	10.00			
S-R	0 / 2308	-18.5	-18.5 0.42 (1)	10.00			
R-Q	0 / 2308	-18.5	-18.5 0.42 (1)	10.00			
Q-P	0 / 2308	-18.5	-18.5 0.42 (1)	10.00			
P-O	0 / 2308	-18.5	-18.5 0.42 (1)	10.00			
O-N	0 / 1535	-18.5	-18.5 0.35 (1)	10.00			
N-M	0 / 1433	-18.5	-18.5 0.33 (1)	10.00			

TOTAL WEIGHT = 2 X 162 = 323 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.8 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 888-09, CSA 888-14
- TPIG 2011, TPIG 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (1.17)
CALCULATED VERT. DEFL. (LL) = $L/998$ (0.13")
ALLOWABLE DEFL. (TL) = $L/360$ (1.17)
CALCULATED VERT. DEFL. (TL) = $L/998$ (0.23")

CSI: TG=0.57/1.00 (E-F:1), BC=0.42/1.00 (O-Q:1), WB=0.88/1.00 (J-M:1), SSI=0.24/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788
		1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (I) (INPUT = 0.90)
JSI METAL= 0.72 (P) (INPUT = 1.00)

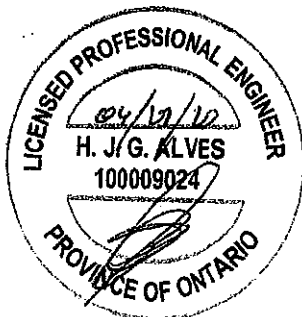


Structural component only
DWG# T-2007085

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408151	T24	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 11:19:49 2020 Page 1

ID:h2dlfgC44wS E2tzqPs_atzllRw-a4RuagpEsO?ne9UbDd4W_QTXEPW57ssNp3MEjzNOX9



LUMBER	CHORDS	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES	A - D	2x4	DRY	No.2	SPF
	D - F	2x4	DRY	No.2	SPF
	F - H	2x4	DRY	No.2	SPF
	H - K	2x4	DRY	No.2	SPF
	S - B	2x4	DRY	No.2	SPF
	L - J	2x4	DRY	No.2	SPF
	S - Q	2x4	DRY	No.2	SPF
	Q - N	2x4	DRY	No.2	SPF
	N - L	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
S - C	2x4	DRY	No.2	SPF	
I - L	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMW+p	MT20	3.0	4.0		
C TMWW-1	MT20	5.0	8.0	2.50	2.50
D TTWW+m	MT20	5.0	8.0	2.00	1.75
E TMWW-1	MT20	4.0	4.0		
F TS-1	MT20	3.0	6.0		
G TMW+w	MT20	2.0	4.0		
H TTWW+m	MT20	5.0	8.0	2.00	1.75
I TMW+p	MT20	5.0	8.0	2.50	2.50
J TMW+p	MT20	3.0	4.0		
L BMWV-1	MT20	5.0	8.0		
M BMWV-1	MT20	4.0	4.0		
N BS-1	MT20	3.0	6.0		
O BMWV-1	MT20	4.0	4.0		
P BMWV-1	MT20	4.0	4.0		
Q BS-1	MT20	3.0	6.0		
R BMWV-1	MT20	4.0	4.0		
S BMWV-1	MT20	5.0	8.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	HORZ	DOWN	HORZ	UPLIFT
S	2068	0	2068	0
L	2068	0	2068	0

UNFACTORED REACTIONS

1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	1458	971.0	0/0	0/0	0/0	488.0	0/0
L	1458	971.0	0/0	0/0	0/0	488.0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.81 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	MAX. CSI (LC)	MAX. UNBRACED LENGTH	WEBS	MAX. FACTORED	MAX. CSI (LC)
MEMB.	FORCE (LBS)	FROM	TO	CSI (LC)	LENGTH	MEMB.	FORCE (LBS)	MAX. CSI (LC)
FR-TO						FR-TO		
A-B	0/41	-91.8	-91.8	0.13 (1)	10.00	C-R	0/84	0.02 (4)
B-C	0/26	-91.8	-91.8	0.21 (1)	10.00	R-D	0/126	0.04 (4)
C-D	-2006/0	-91.8	-91.8	0.29 (1)	4.50	D-P	0/998	0.22 (1)
D-E	-2163/0	-91.8	-91.8	0.73 (1)	3.81	P-E	-650/0	0.82 (1)
E-F	-2162/0	-91.8	-91.8	0.73 (1)	3.81	E-O	-2/0	0.00 (1)
F-G	-2162/0	-91.8	-91.8	0.73 (1)	3.81	O-G	-649/0	0.82 (1)
G-H	-2162/0	-91.8	-91.8	0.73 (1)	3.82	H-O	0/998	0.22 (1)
H-I	-2006/0	-91.8	-91.8	0.29 (1)	4.50	M-H	0/126	0.04 (4)
I-J	0/26	-91.8	-91.8	0.21 (1)	10.00	M-I	0/84	0.02 (4)
J-K	0/41	-91.8	-91.8	0.13 (1)	10.00	S-G	-2291/0	0.97 (1)
S-B	-264/0	0.0	0.0	0.03 (1)	7.81	I-L	-2291/0	0.97 (1)
L-J	-264/0	0.0	0.0	0.03 (1)	7.81			
S-R	0/1487	-18.5	-18.5	0.38 (1)	10.00			
R-Q	0/1519	-18.5	-18.5	0.39 (1)	10.00			
Q-P	0/1519	-18.5	-18.5	0.39 (1)	10.00			
P-O	0/2163	-18.5	-18.5	0.42 (1)	10.00			
O-N	0/1519	-18.5	-18.5	0.39 (1)	10.00			
N-M	0/1519	-18.5	-18.5	0.39 (1)	10.00			
M-L	0/1487	-18.5	-18.5	0.38 (1)	10.00			

TOTAL WEIGHT = 2 X 183 = 326 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.21")

CS: TC=0.73/1.00 (D-E:1), BC=0.42/1.00 (O-P:1),
WB=0.97/1.00 (I-L:1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.87 (i) (INPUT = 0.90)
JSI METAL= 0.58 (i) (INPUT = 1.00)

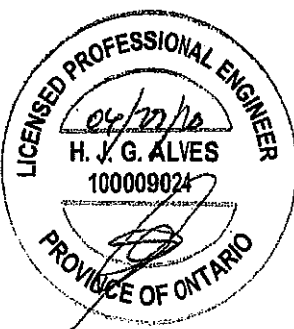

Structural component only
DWG# T-2007086

JOB NAME 408151	TRUSS NAME T25	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Sat Apr 25 11:19:50 2020 Page 1
ID:h2dligC44wS E2tzqPs alziIFw-2G7Ho0psdh7eGJ2nnKoiXdx0n8pt_sTo?cTpm92NCXc
Scale = 1/32'

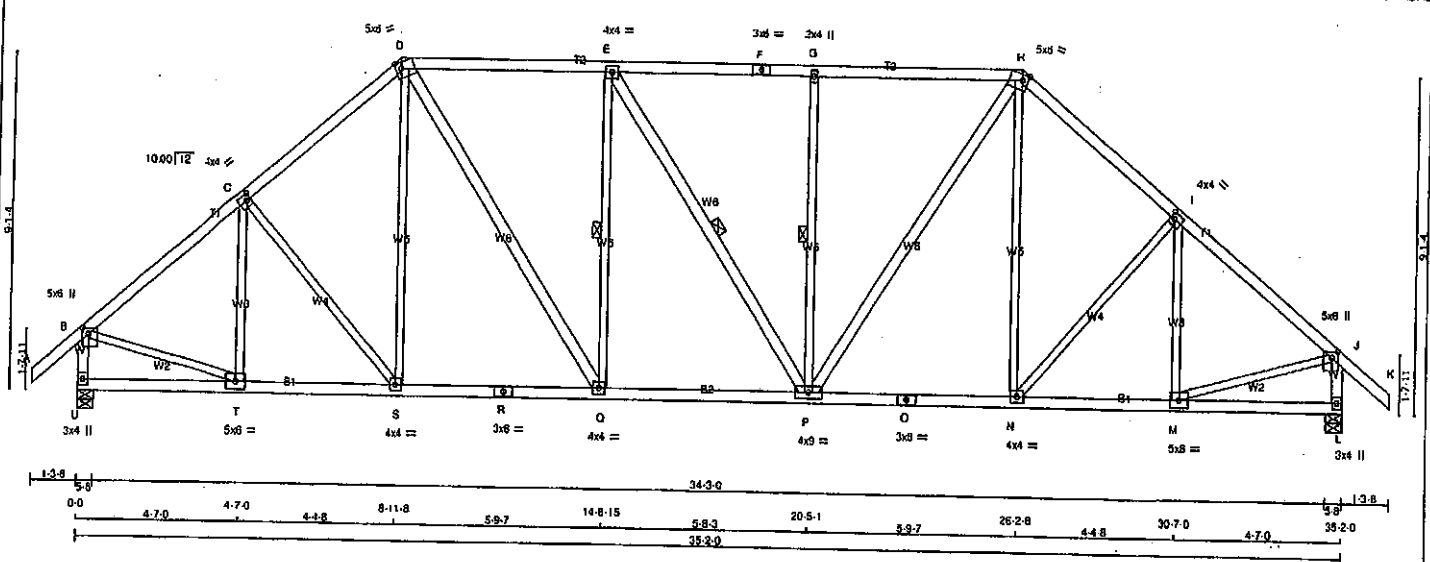

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - K	2x4	DRY	No.2	SPF
U - B	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
U - R	2x4	DRY	No.2	SPF
R - O	2x4	DRY	No.2	SPF
O - L	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
D - Q	2x4	DRY	No.2	SPF
E - P	2x4	DRY	No.2	SPF
P - H	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMW-w	MT20	5.0	6.0	2.00	2.00
C	TMW-w	MT20	4.0	4.0	2.00	1.25
D	TMW-w	MT20	5.0	6.0	2.00	1.75
E	TMW-w	MT20	4.0	4.0		
F	TS-1	MT20	3.0	6.0		
G	TMW-w	MT20	5.0	6.0	2.00	1.75
H	TMW-w	MT20	4.0	4.0	2.00	1.25
I	TMW-w	MT20	5.0	6.0	2.00	2.00
J	TMW-w	MT20	3.0	4.0		
L	BMW-1-p	MT20	5.0	6.0		
M	BMW-1-p	MT20	3.0	4.0		
N, O, S						
N	BMW-1	MT20	4.0	4.0		
O	BS-1	MT20	3.0	6.0		
P	BMW-1	MT20	4.0	4.0		
Q	BS-1	MT20	3.0	6.0		
R	BMW-1	MT20	5.0	6.0		
T	BMW-1-p	MT20	3.0	4.0		
U	BMW-1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG
U	VERT	DOWN	IN-SX	IN-SX
L	2066	0	5-8	5-8

UNFACTORED REACTIONS

1ST CASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	LIVE
U	1458	971 / 0
L	1458	971 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.44 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-Q, E-P, G-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)
FR-TO					FR-TO		
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	T-C	-357 / 0
B-C	-1994 / 0	-91.8	-91.8	0.30 (1)	4.53	C-S	-121 / 0
C-D	-1857 / 0	-91.8	-91.8	0.29 (1)	4.57	S-D	0 / 188
D-E	-1823 / 0	-91.8	-91.8	0.40 (1)	4.44	D-Q	0 / 810
E-F	-1921 / 0	-91.8	-91.8	0.37 (1)	4.48	Q-E	-569 / 0
F-G	-1921 / 0	-91.8	-91.8	0.37 (1)	4.49	E-P	-3 / 0
G-H	-1921 / 0	-91.8	-91.8	0.40 (1)	4.45	P-G	-568 / 0
H-I	-1957 / 0	-91.8	-91.8	0.29 (1)	4.57	P-H	0 / 807
I-J	-1994 / 0	-91.8	-91.8	0.30 (1)	4.53	H-N	0 / 169
J-K	0 / 41	-91.8	-91.8	0.13 (1)	10.00	N-I	-121 / 0
U-B	-2028 / 0	0.0	0.0	0.22 (1)	5.94	M-I	-358 / 0
L-J	-2028 / 0	0.0	0.0	0.22 (1)	5.94	B-Y	0 / 1817
U-T	0 / 0	-18.5	-18.5	0.08 (4)	10.00	M-J	0 / 1817
T-S	0 / 1555	-18.5	-18.5	0.30 (1)	10.00		
S-R	0 / 1477	-18.5	-18.5	0.30 (1)	10.00		
R-Q	0 / 1477	-18.5	-18.5	0.30 (1)	10.00		
Q-P	0 / 1923	-18.5	-18.5	0.39 (1)	10.00		
P-O	0 / 1478	-18.5	-18.5	0.30 (1)	10.00		
O-N	0 / 1478	-18.5	-18.5	0.30 (1)	10.00		
N-M	0 / 1555	-18.5	-18.5	0.31 (1)	10.00		
M-L	0 / 0	-18.5	-18.5	0.08 (4)	10.00		

TOTAL WEIGHT = 2 X 182 = 363 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCG 2018, OBC 2012, ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.16")

CSI: TC=0.40/1.00 (D-E:1), BC=0.38/1.00 (P-Q:1), WB=0.35/1.00 (B-T:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 334 1687 788 1687 1656

PLATE PLACEMENT TOL. = 0.250 inches



PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (B) (INPUT = 0.90)
JSI METAL = 0.50 (C) (INPUT = 1.00)

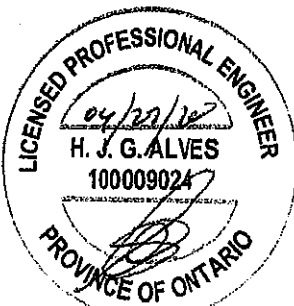


Structural component only
DWG# T-2007087

Scale = 1:57.4

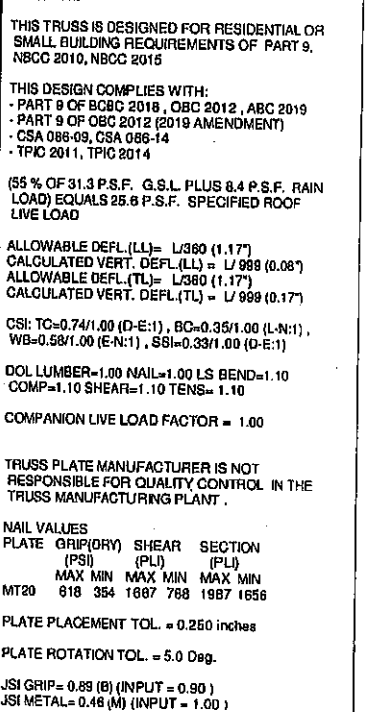

JOB NAME 408151	TRUSS NAME T27	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:18:53 2020 Page 1	
ID:h2dlfgC44wS_E2tqPa_atzllRw-TrgPQ2slvcVC7mmMST9S9GeHs1uT3o2SIR1ZNUzNCXa				35.20 38.56 1.2	

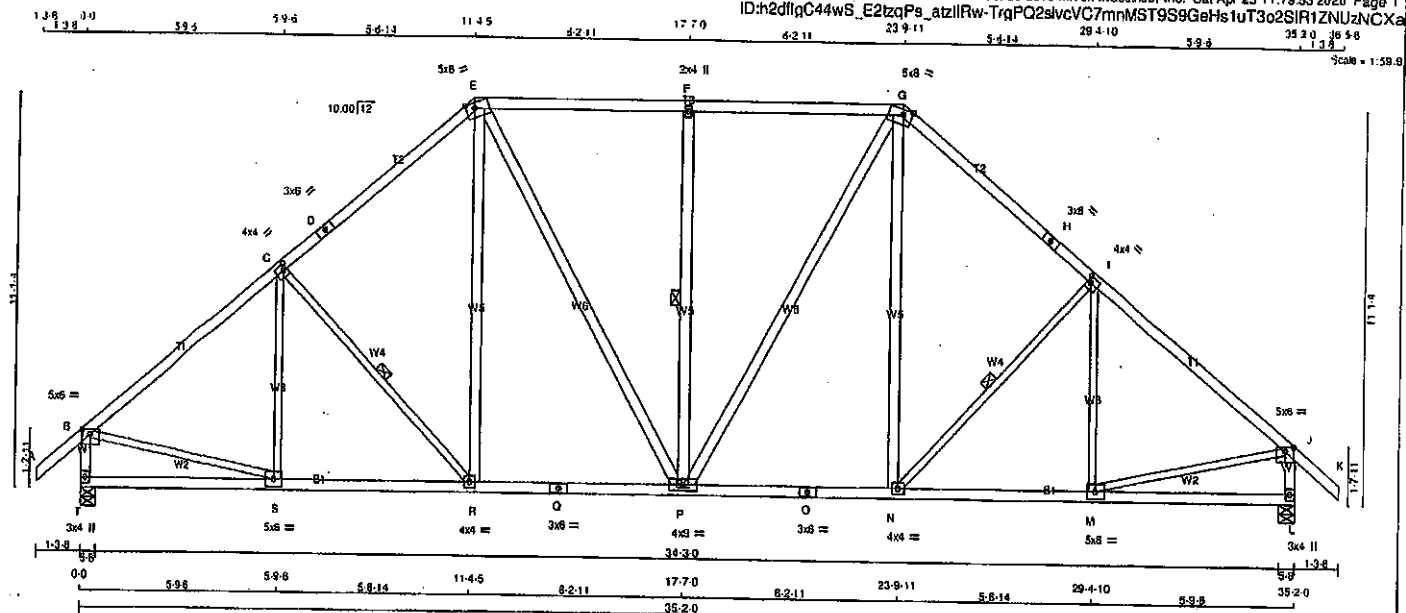

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4 DRY	No.2	SPF		
D - E	2x4 DRY	No.2	SPF		
E - G	2x4 DRY	No.2	SPF		
G - H	2x4 DRY	No.2	SPF		
H - K	2x4 DRY	No.2	SPF		
T - 8	2x4 DRY	No.2	SPF		
L - J	2x4 DRY	No.2	SPF		
T - Q	2x4 DRY	No.2	SPF		
Q - O	2x4 DRY	No.2	SPF		
O - L	2x4 DRY	No.2	SPF		
ALL WEBS EXCEPT	2x4 DRY	No.2	SPF		
S - C	2x3 DRY	No.2	SPF		
C - R	2x3 DRY	No.2	SPF		
N - I	2x3 DRY	No.2	SPF		
M - I	2x3 DRY	No.2	SPF		
B - S	2x3 DRY	No.2	SPF		
M - J	2x3 DRY	No.2	SPF		

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	8.0	1.50	3.00
C TMVW-l	MT20	4.0	4.0	2.00	1.25
D TS-l	MT20	3.0	8.0		
E TMVW-m	MT20	5.0	8.0	Edge	3.00
F TMVW-w	MT20	2.0	4.0		
G TMVW-m	MT20	5.0	8.0	Edge	3.00
H TS-l	MT20	3.0	8.0		
I TMVW-l	MT20	4.0	4.0	2.00	1.25
J TMVW-p	MT20	5.0	8.0	1.50	3.00
L BMV-l-p	MT20	3.0	4.0		
M BMVW-l	MT20	5.0	8.0		
N BMVW-l	MT20	4.0	4.0		
O BS-l	MT20	3.0	8.0		
P BMVW-w	MT20	4.0	4.0		
Q BS-l	MT20	3.0	8.0		
R BMVW-l	MT20	4.0	4.0		
S BMVW-l	MT20	5.0	8.0		
T BMV-l-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	DOWN	UP	IN-SX
T	2068	0	0	5.8
L	2068	0	0	5.8

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
T	1458	871/0	0/0	0/0	0/0	0/0	488/0	0/0
L	1458	871/0	0/0	0/0	0/0	0/0	488/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.27 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-R, F-P, W-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED	MAX.
MEMB.	FORCE (LBS)	FORCE (LBS)	FROM	TO	CSI (LC)	UNBRACED LENGTH	FR-TO	FORCE (LBS)	CSI (LC)
A-B	0/41	-91.8	-91.8	0.13 (1)	10.00	S-C	-245/10	0.17 (1)	
B-C	-2039/0	-91.8	-91.8	0.50 (1)	4.27	C-R	-314/0	0.15 (1)	
C-D	-1844/0	-91.8	-91.8	0.46 (1)	4.47	R-E	0/338	0.05 (1)	
D-E	-1844/0	-91.8	-91.8	0.46 (1)	4.47	E-P	0/489	0.08 (1)	
E-F	-1621/0	-91.8	-91.8	0.50 (1)	4.60	P-G	-899/0	0.45 (1)	
F-G	-1621/0	-91.8	-91.8	0.50 (1)	4.60	G-H	0/489	0.08 (1)	
G-H	-1844/0	-91.8	-91.8	0.46 (1)	4.47	H-I	0/338	0.05 (1)	
H-I	-1844/0	-91.8	-91.8	0.46 (1)	4.47	I-J	-314/0	0.15 (1)	
I-J	-2039/0	-91.8	-91.8	0.50 (1)	4.27	J-K	-245/10	0.17 (1)	
J-K	0/41	-91.8	-91.8	0.13 (1)	10.00	K-L	0/1637	0.37 (1)	
K-L	-2021/0	0.0	0.0	0.21 (1)	5.94	L-M	0/1637	0.37 (1)	
L-M	-2021/0	0.0	0.0	0.21 (1)	5.94				
T-S	0/0	-18.5	-18.5	0.14 (4)	10.00				
S-R	0/1597	-18.5	-18.5	0.33 (1)	10.00				
R-Q	0/1387	-18.5	-18.5	0.30 (1)	10.00				
Q-P	0/1387	-18.5	-18.5	0.30 (1)	10.00				
P-O	0/1387	-18.5	-18.5	0.30 (1)	10.00				
O-N	0/1387	-18.5	-18.5	0.30 (1)	10.00				
N-M	0/1597	-18.5	-18.5	0.33 (1)	10.00				
M-L	0/0	-18.5	-18.5	0.14 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL	6.0	PSF
BOT CH.	LL = 0.0	PSF
DL	7.4	PSF
TOTAL LOAD	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.50/1.00 (E-F:1), BC=0.33/1.00 (M-N:1), WB=0.45/1.00 (F-P:1), SS=0.28/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX	MIN	MAX
MT20	618	354
	1667	788
	1907	1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.89 (J) (INPUT = 0.90)
JSI METAL= 0.47 (O) (INPUT = 1.00)



Structural component only
DWG# T-2007089

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408151	T28	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 11:19:54 2020 Page 1
ID:h2dflgC44wS_E2tzqPs_atzIRw-x1EndOINgwd3kwMZ0AghhTAWTQH0b7bX5n7vxzNCKZ

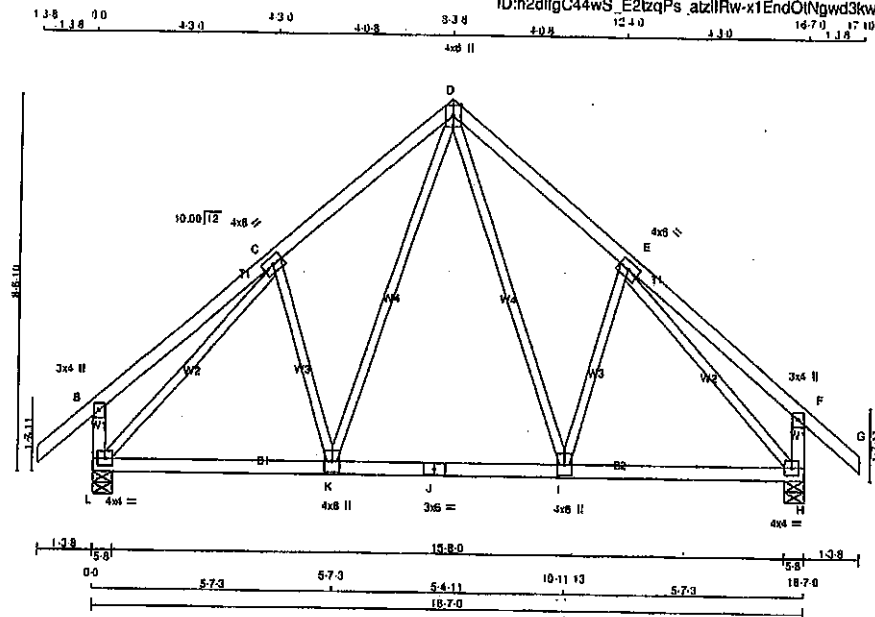

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
L - B	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	

EXCEPT
DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-t	MT20	4.0	8.0		
D	TTWW+p	MT20	4.0	8.0		Edge
E	TMVW-t	MT20	4.0	8.0		
F	TMV+p	MT20	3.0	4.0		
H	BMVW-t	MT20	4.0	4.0		
I	BMVW-t	MT20	4.0	8.0		
J	BS-t	MT20	3.0	8.0		
K	BMVW-t	MT20	4.0	8.0		
L	BMVW-t	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
L	1041	0	1041	0	0	5-8	5-8
H	1041	0	1041	0	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
L	734	495 / 0	0 / 0	0 / 0	239 / 0	0 / 0
H	734	495 / 0	0 / 0	0 / 0	239 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. UNBRACED LENGTH (L)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (L)
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	0 - 1	0 / 339
B-C	0 / 29	-91.8	-91.8	0.26 (1)	10.00	1 - E	-222 / 0
C-D	-764 / 0	-91.8	-91.8	0.20 (1)	6.25	K - O	0 / 339
D-E	-764 / 0	-91.8	-91.8	0.20 (1)	6.25	C - K	-222 / 0
E-F	0 / 29	-91.8	-91.8	0.26 (1)	10.00	L - C	-904 / 0
F-G	0 / 41	-91.8	-91.8	0.13 (1)	10.00	E - H	-904 / 0
L-B	-270 / 0	0.0	0.0	0.03 (1)	7.81		
H-F	-270 / 0	0.0	0.0	0.03 (1)	7.81		
L-K	0 / 632	-18.5	-18.5	0.18 (4)	10.00		
K-J	0 / 459	-18.5	-18.5	0.17 (4)	10.00		
J-I	0 / 459	-18.5	-18.5	0.17 (4)	10.00		
I-H	0 / 632	-18.5	-18.5	0.18 (4)	10.00		

TOTAL WEIGHT = 2 X 82 = 163 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.55")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.55")
CALCULATED VERT. DEFL. (TL) = L/999 (0.04")

CSI: TC=0.28/1.00 (B-C:1), BC=0.18/1.00 (H-I:4),
WB=0.88/1.00 (E-H:1), SSI=0.14/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 789 1987 1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.78 (C) (INPUT = 0.90)
JSI METAL = 0.25 (C) (INPUT = 1.00)

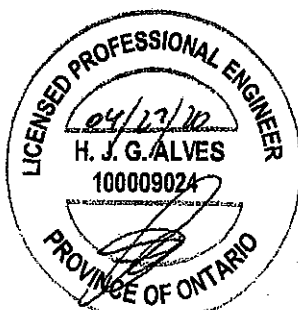


Structural component only
DWG# T-2007090

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408151	T29	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

TRUSS DESC.

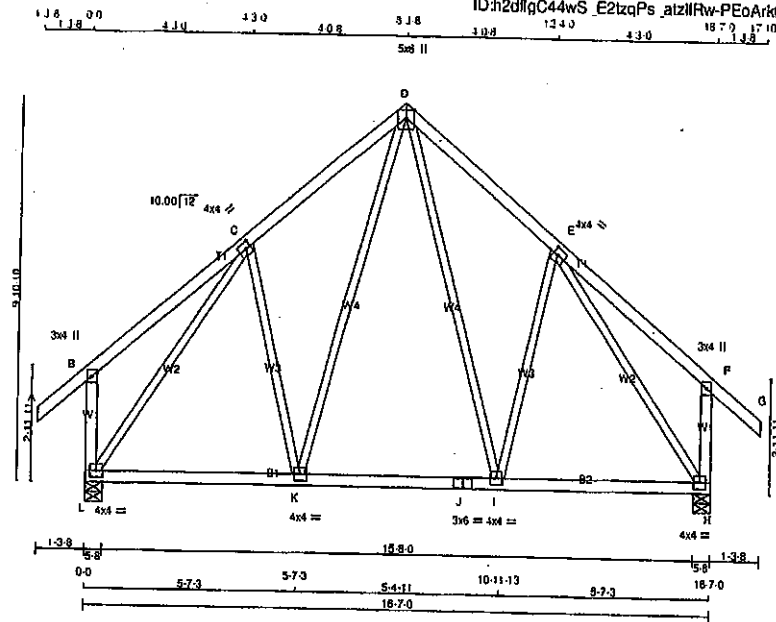

Version 8.310 5 Oct 2019 Mitek Industries, Inc. Sat Apr 25 11:19:55 2020 Page 1
ID:h2dflgC44wS E2tqPs alzlRw-PEoArM?RElWm4xlatBwEhlg9qdOXaSkmlWgSNzNCXY

Scale = 1/8" = 1'-0"

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No. 2
D - G	2x4	DRY	No. 2
L - B	2x4	DRY	No. 2
H - F	2x4	DRY	No. 2
J - H	2x4	DRY	No. 2
L - J	2x4	DRY	No. 2

ALL WEBS 2x3 DRY No. 2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-1	MT20	4.0	4.0	2.00	1.50
D	TTWW+p	MT20	5.0	6.0	Edge	
E	TMWW-1	MT20	4.0	4.0	2.00	1.50
F	TMV+p	MT20	3.0	4.0		
H	BMVW1-1	MT20	4.0	4.0		
I	BMVW1-1	MT20	4.0	4.0		
J	BS-1	MT20	3.0	6.0		
K	BMVW1-1	MT20	4.0	4.0		
L	BMVW1-1	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

DESCR.	SPF	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	SPF	VERT	DOWN	UP	IN-SX
L	SPF	1041	0	0	5-8
H	SPF	1041	0	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
L	734	495/0	0/0	0/0	0/0	0/0	239/0	0/0
H	734	495/0	0/0	0/0	0/0	0/0	239/0	0/0

BEARING MATERIAL TO BE SPF NO. 2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PL)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO				FR-TO			
A-B	0/41	-91.8	-91.8 0.13 (1)	D-I	0/254	10.00	0.06 (1)
B-C	0/28	-91.8	-91.8 0.28 (1)	E-H	-138/14	10.00	0.10 (1)
C-D	-633/0	-91.8	-91.8 0.20 (1)	K-D	0/254	6.25	0.06 (1)
D-E	-633/0	-91.8	-91.8 0.20 (1)	C-K	-138/14	6.25	0.10 (1)
E-F	0/28	-91.8	-91.8 0.13 (1)	L-C	-875/0	10.00	0.90 (1)
F-G	0/41	-91.8	-91.8 0.13 (1)	E-H	-875/0	10.00	0.90 (1)
L-B	-278/0	0.0	0.0 0.04 (1)				
H-F	-278/0	0.0	0.0 0.04 (1)				
L-K	0/495	-18.5	-18.5 0.17 (4)				
K-J	0/395	-18.5	-18.5 0.16 (4)				
J-I	0/395	-18.5	-18.5 0.16 (4)				
I-H	0/495	-18.5	-18.5 0.17 (4)				

TOTAL WEIGHT = 91 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = 1/360 (0.55")
CALCULATED VERT. DEFL. (LL) = 1/999 (0.02")
ALLOWABLE DEFL. (TL) = 1/360 (0.55")
CALCULATED VERT. DEFL. (TL) = 1/999 (0.04")

CSI: TC=0.28/1.00 (E-F:1), BC=0.17/1.00 (K-L:4), WB=0.90/1.00 (E-H:1), SS=0.14/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.88 (E) (INPUT=0.90)
JSI METAL=0.34 (C) (INPUT=1.00)

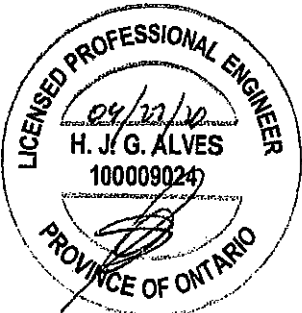

Structural component only
DWG# T-2007091

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408151	T30	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 5 Oct 29 2019 Mtek Industries, Inc. Sat Apr 25 11:19:56 2020 Page 1	

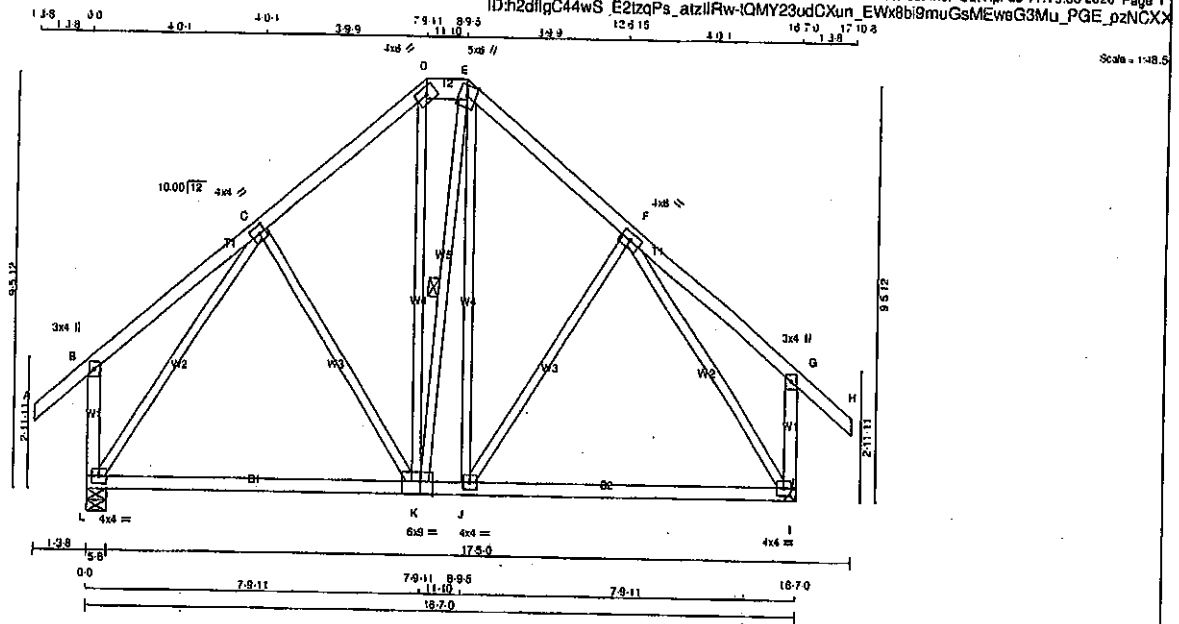

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
E - H	2x6	DRY	No.2
I - J	2x4	DRY	No.2
K - L	2x4	DRY	No.2
M - N	2x4	DRY	No.2
O - P	2x4	DRY	No.2
Q - R	2x4	DRY	No.2
S - T	2x4	DRY	No.2
U - V	2x4	DRY	No.2
W - X	2x4	DRY	No.2
Y - Z	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV-p	MT20	3.0	4.0		
C	TMW-t	MT20	4.0	4.0	2.00	1.75
D	TTW-h	MT20	4.0	8.0		
E	TTW-m	MT20	5.0	8.0	Edge	
F	TMW-t	MT20	4.0	8.0		
G	TMV-p	MT20	3.0	4.0		
I	BMVW-1	MT20	4.0	4.0		
J	BMW-1	MT20	4.0	4.0		
K	BSWVW-1	MT20	6.0	9.0	Edge	3.75
L	BSW-1	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	HORZ	GROSS REACTION	DOWN	HORZ	BRG	BRG
L	1041	0	1041	0	0	5-8	5-8
I	1041	0	1041	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
L	734	495 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	239 / 0	0 / 0
I	734	495 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	239 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD	LC1 MAX (PLF)	MAX. CSI (L/C)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (L/C)	
FR-TO		FROM	TO			FR-TO			
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	C-K	-98 / 9	0.09 (1)	
B-C	0 / 27	-91.8	-91.8	0.23 (1)	10.00	K-D	0 / 164	0.04 (1)	
C-D	-566 / 0	-91.8	-91.8	0.19 (1)	8.25	K-E	-109 / 0	0.07 (4)	
D-E	-414 / 0	-91.8	-91.8	0.01 (1)	8.25	J-E	0 / 286	0.07 (4)	
E-F	-582 / 0	-91.8	-91.8	0.19 (1)	8.25	J-F	-93 / 15	0.09 (1)	
F-G	0 / 27	-91.8	-91.8	0.23 (1)	10.00	L-C	-848 / 0	0.78 (1)	
G-H	0 / 41	-91.8	-91.8	0.13 (1)	10.00	F-I	-582 / 0	0.79 (1)	
L-B	-265 / 0	0.0	0.0	0.04 (1)	7.81				
I-G	-265 / 0	0.0	0.0	0.04 (1)	7.81				
L-K	0 / 468	-18.5	-18.5	0.38 (4)	10.00				
K-J	0 / 424	-18.5	-18.5	0.30 (4)	10.00				
J-I	0 / 477	-18.5	-18.5	0.30 (4)	10.00				

TOTAL WEIGHT = 97 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.55")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.55")
CALCULATED VERT. DEFL. (TL) = L/999 (0.17")

CSK: TC=0.23/1.00 (B-C:1), BC=0.38/1.00 (K-L:4), WB=0.79/1.00 (F-I:1), SS=0.14/1.00 (J-K:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (C) (INPUT = 0.90)
JSI METAL = 0.31 (C) (INPUT = 1.00)

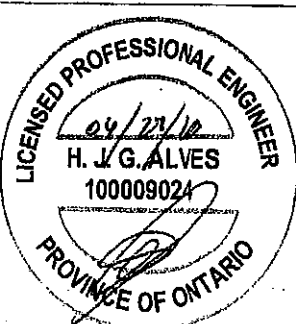

Structural component only
DWG# T-2007092

JOB NAME 408151	TRUSS NAME T31	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:19:57 2020 Page 1	

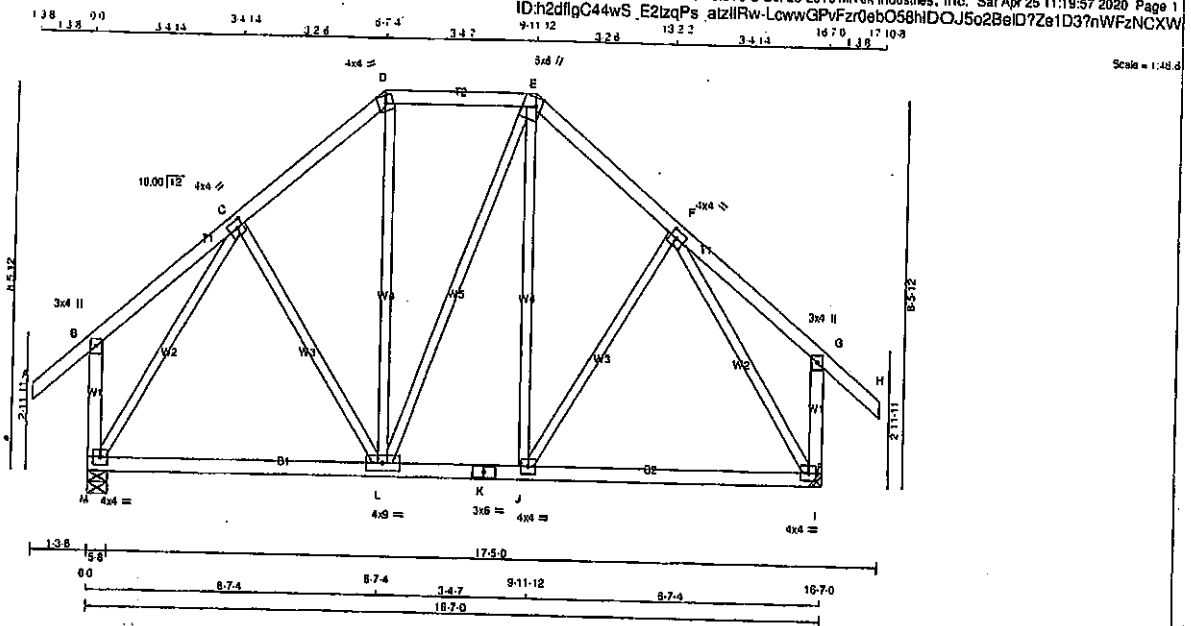

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - H	2x4	DRY	No.2
M - B	2x4	DRY	No.2
F - G	2x4	DRY	No.2
M - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-I	MT20	4.0	4.0	2.00	1.75
D	TTW-m	MT20	4.0	4.0		
E	TTWV+m	MT20	5.0	6.0	2.25	1.50
F	TMVW-I	MT20	4.0	4.0	2.00	1.75
G	TMV+p	MT20	3.0	4.0		
I	BMVW-I	MT20	4.0	4.0		
J	BMVW-I	MT20	4.0	4.0		
K	BS-I	MT20	3.0	6.0		
L	BMVWV-I	MT20	4.0	9.0		
M	BMVW-I	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
M	1041	0	1041	0	0	5-8	5-8
I	1041	0	1041	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. LIVE	PERM. LIVE	WIND	DEAD	SOIL
M	734	495/0	0/0	0/0	239/0	0/0
I	734	495/0	0/0	0/0	239/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO				FR-TO			
A-B	0/41	-91.8	-91.8 0.13 (1)	C-L	-10/34	0.01 (4)	
B-C	0/22	-91.8	-91.8 0.16 (1)	L-D	0/110	0.03 (4)	
C-D	-613/0	-91.8	-91.8 0.13 (1)	L-E	0/0	0.00 (1)	
D-E	-453/0	-91.8	-91.8 0.14 (1)	J-E	0/109	0.03 (4)	
E-F	-612/0	-91.8	-91.8 0.13 (1)	J-F	-11/34	0.01 (4)	
F-G	0/22	-91.8	-91.8 0.16 (1)	M-C	-873/0	0.60 (1)	
G-H	0/41	-91.8	-91.8 0.13 (1)	F-I	-873/0	0.60 (1)	
M-B	-245/0	0.0	0.0 0.04 (1)				
I-G	-245/0	0.0	0.0 0.04 (1)				
M-L	0/457	-18.5	-18.5 0.21 (4)				
L-K	0/453	-18.5	-18.5 0.20 (4)				
K-J	0/453	-18.5	-18.5 0.20 (4)				
J-I	0/457	-18.5	-18.5 0.21 (4)				

TOTAL WEIGHT = 92 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.0/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.55")
CALCULATED VERT. DEFL. (LL) = L/989 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.55")
CALCULATED VERT. DEFL. (TL) = L/989 (0.07")

CS1: TC=0.16/1.00 (F-G:1), BC=0.21/1.00 (H-J:4),
WB=0.80/1.00 (C-M:1), SSI=0.12/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN
MT20 618 354 1887 788 1887 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (C) (INPUT = 0.90)
JSI METAL= 0.31 (C) (INPUT = 1.00)

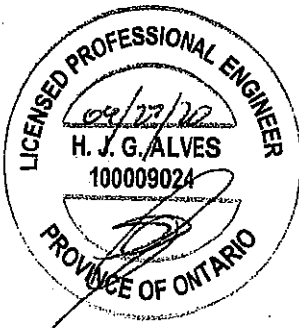

Structural component only
DWG# T-2007093

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408151	T32	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

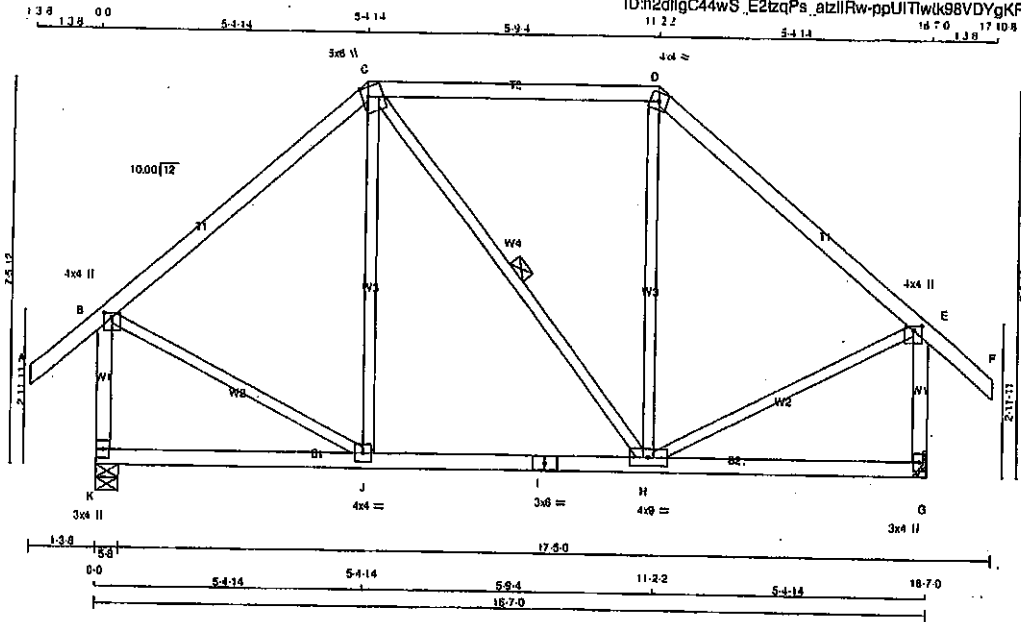

Scale: 1/4\"/>

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
K - B	2x4	DRY	No.2
G - E	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTWW+m	MT20	5.0	6.0	2.25	1.50
D	TTW-m	MT20	4.0	4.0		
E	TMVW+p	MT20	4.0	4.0	1.00	2.00
G	BMV1+p	MT20	3.0	4.0		
H	BMWWW-t	MT20	4.0	9.0		
I	BS-I	MT20	3.0	6.0		
J	BMWW-t	MT20	4.0	4.0		
K	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
K	1041	0	1041	0	5-8
G	1041	0	1041	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	734	485 / 0	0 / 0	0 / 0	0 / 0	0 / 0	239 / 0	0 / 0
G	734	485 / 0	0 / 0	0 / 0	0 / 0	0 / 0	239 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-H.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 41	-91.8 -91.8	0.13 (1)	J-C	-115 / 46	0.12 (1)	
B-C	-619 / 0	-91.8 -91.8	0.35 (1)	G-H	0 / 0	0.00 (1)	
C-D	-473 / 0	-91.8 -91.8	0.39 (1)	H-D	-115 / 46	0.12 (1)	
D-E	-619 / 0	-91.8 -91.8	0.35 (1)	B-J	0 / 526	0.12 (1)	
E-F	0 / 41	-91.8 -91.8	0.13 (1)	H-E	0 / 526	0.12 (1)	
K-B	-1000 / 0	0.0 0.0	0.16 (1)				
G-E	-1000 / 0	0.0 0.0	0.16 (1)				
K-J	0 / 0	-18.5 -18.5	0.13 (4)				
J-I	0 / 473	-18.5 -18.5	0.17 (4)				
I-H	0 / 473	-18.5 -18.5	0.17 (4)				
H-G	0 / 0	-18.5 -18.5	0.13 (4)				

TOTAL WEIGHT = 79 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.55")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.55")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSI: TC=0.39/1.00 (C-D:1), BC=0.17/1.00 (H-J:4), WB=0.12/1.00 (B-J:1), SSI=0.21/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1987 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.82 (B) (INPUT = 0.90)
JSI METAL = 0.23 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007094

JOB NAME 408151	TRUSS NAME G33	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 5 Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 11:19:40 2020 Page 1
ID:h2dflgC44wS_E2tzqPs_atzlfRw-LLOVhbibzd23nlsCEQP7Wb90nX9W01XJvONQkzNCXn

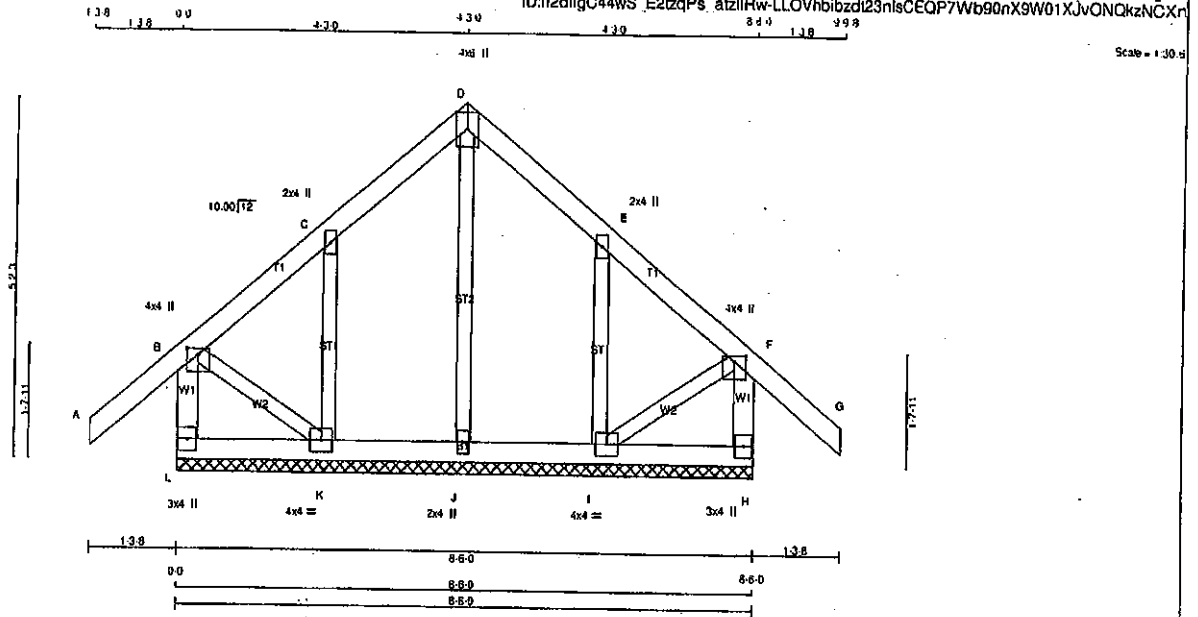

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
L - B	2x4	DRY No.2
A - D	2x4	DRY No.2
D - G	2x4	DRY No.2
H - F	2x4	DRY No.2
L - H	2x4	DRY No.2

ALL WEBS 2x3 DRY No.2

ALL GABLE WEBS 2x3 DRY No.2

DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00
C TMVW+w	MT20	2.0	4.0		
D TTW+p	MT20	4.0	6.0	Edge	
E TMVW+w	MT20	2.0	4.0		
F TMVW+p	MT20	4.0	4.0	1.00	2.00
H BMV1+p	MT20	3.0	4.0		
I BMVW1-t	MT20	4.0	4.0		
J BMV1+w	MT20	2.0	4.0		
K BMVW1-t	MT20	4.0	4.0		
L BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRACED LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH FR-TO
L-B	-231 / 0	0.0	0.02 (1)	7.81	J-D	-123 / 0	0.05 (1)
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00	K-C	-236 / 0	0.05 (1)
B-C	-11 / 0	-91.8	-91.8 0.07 (1)	8.25	I-E	-236 / 0	0.05 (1)
C-D	-32 / 0	-91.8	-91.8 0.07 (1)	8.25	B-K	0 / 23	0.01 (1)
D-E	-32 / 0	-91.8	-91.8 0.07 (1)	8.25	I-F	0 / 23	0.01 (1)
E-F	-11 / 0	-91.8	-91.8 0.07 (1)	8.25			
F-G	0 / 41	-91.8	-91.8 0.13 (1)	10.00			
H-F	-231 / 0	0.0	0.02 (1)	7.81			
L-K	0 / 0	-18.5	-18.5 0.02 (4)	10.00			
K-J	0 / 13	-18.5	-18.5 0.02 (4)	10.00			
J-I	0 / 13	-18.5	-18.5 0.02 (4)	10.00			
I-H	0 / 0	-18.5	-18.5 0.02 (4)	10.00			

TOTAL WEIGHT = 42 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.13/1.00 (F-G:1), BC=0.02/1.00 (J-K:4), WB=0.05/1.00 (C-K:1), SS=0.08/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
MT20	618	354	1687
	788	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.18 (C) (INPUT = 0.90)

JSI METAL = 0.13 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007078

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408151	T33X	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

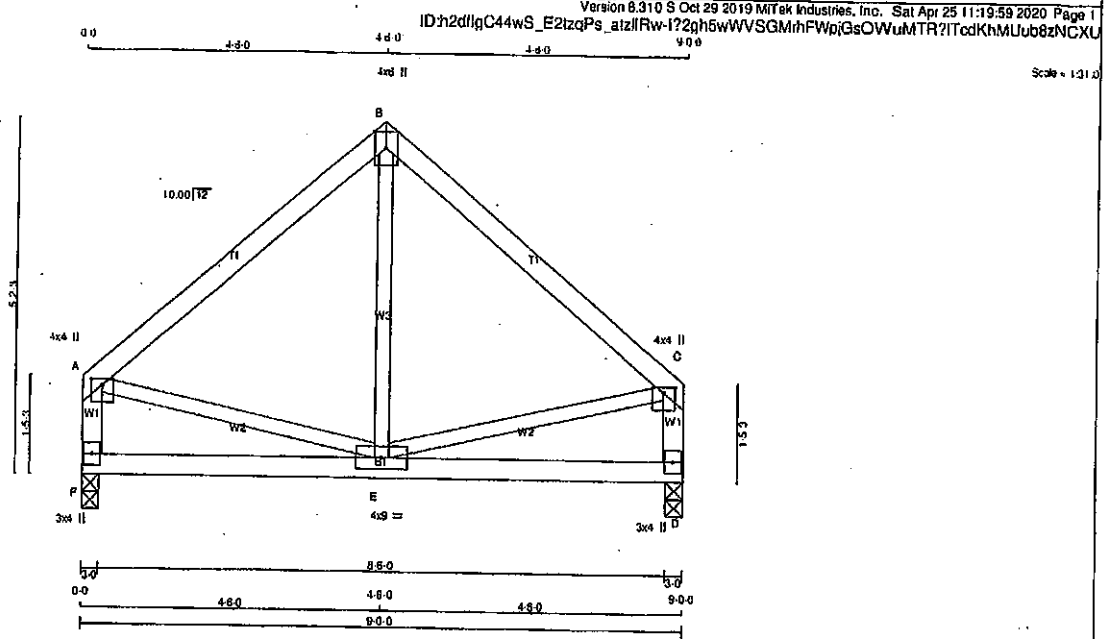

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF		
B - C	2x4	DRY	No.2	SPF		
F - A	2x4	DRY	No.2	SPF		
D - C	2x4	DRY	No.2	SPF		
F - D	2x4	DRY	No.2	SPF		
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.00	2.00
B	TMV+p	MT20	4.0	8.0	Edge	
C	TMVW+p	MT20	4.0	4.0	1.00	2.00
D	BMV1+p	MT20	3.0	4.0		
E	BMVWW-t	MT20	4.0	9.0		
F	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REORD BRG
JT	VERT	HORZ	DOWN	UPLIFT
F	496	0	496	0
D	496	0	496	0

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
F	351	230 / 0	0 / 0	0 / 0	121 / 0	0 / 0
D	351	230 / 0	0 / 0	0 / 0	121 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)
FR-TO						FR-TO			
A-B		-311 / 0	-91.8	-91.8	0.24 (1)	E-B		-14 / 72	0.03 (4)
B-C		-311 / 0	-91.8	-91.8	0.24 (1)	A-E		0 / 248	0.06 (1)
F-A		-464 / 0	0.0	0.0	0.05 (1)	E-C		0 / 248	0.06 (1)
D-C		-464 / 0	0.0	0.0	0.05 (1)				
F-E		0 / 0	-18.5	-18.5	0.11 (4)				
E-D		0 / 0	-18.5	-18.5	0.11 (4)				

TOTAL WEIGHT = 37 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.30")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.30")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.01")

CSI: TC=0.24/1.00 (A-B:1), BC=0.11/1.00 (E-F:4), WB=0.08/1.00 (C-E:1), SSI=0.12/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.42 (A) (INPUT = 0.90)
JSI METAL = 0.12 (A) (INPUT = 1.00)



Structural component only
DWG# T-2007095


Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 11:20:00 2020 .Page 1
ID:7d2ffgC44wS_E2tZqPs_abz1lRw-mBc3uRx8GmODTtpiNfN5xkXQdLiC2aUv0ER7azNCXT



JSI GRIP= 0.33 (A) (INPUT = 0.90)
JSI METAL= 0.09 (A) (INPUT = 1.00)



JOB NAME 408151	TRUSS NAME T35	QUANTITY 2	PLY 2	JOB DESC. GREEN PARK HOMES	ORWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:20:01 2020 Page 1			
		ID:h2dlqC44wS_E2tzqPs_atzllRw-EO9R5nym13W44?Oww8lKTxhdFf_xTud8gz_f1zNCXS			

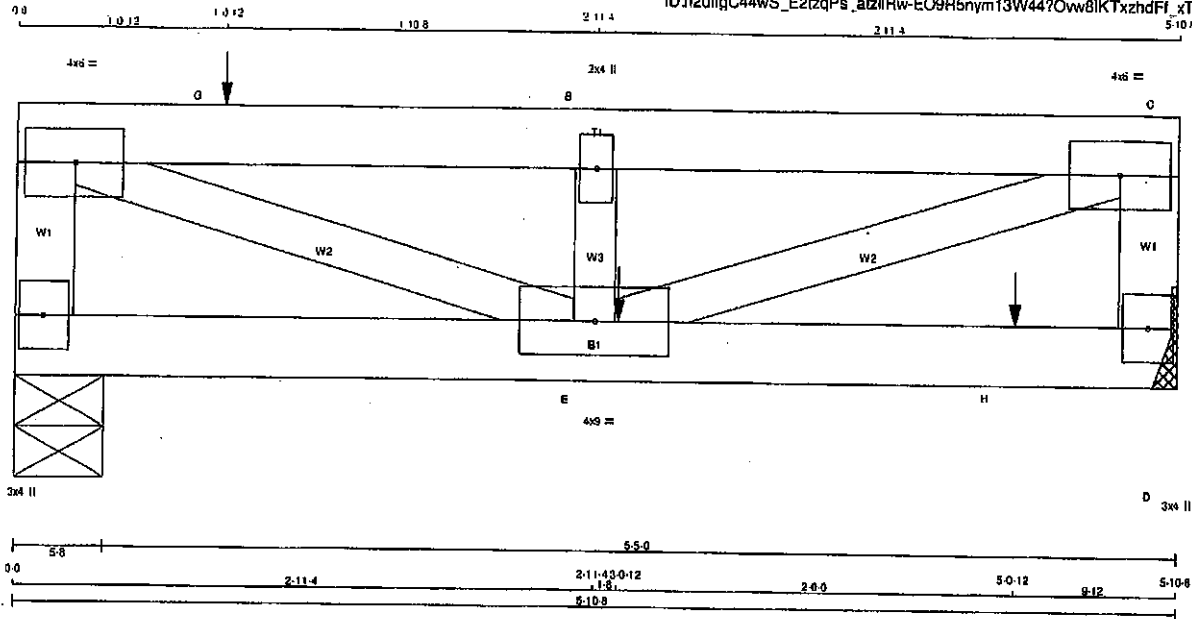

TOTAL WEIGHT = 4 X 20 = 80 lb (M)

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR
F - A	2x4	DRY	No.2		SPF
A - C	2x4	DRY	No.2		SPF
D - C	2x4	DRY	No.2		SPF
F - D	2x4	DRY	No.2		SPF
ALL WEBS		2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER					

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F - A	12	TOP
A - C	12	TOP
C - D	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D	11	SIDE(97.1)
WEBS : (0.122"x3") SPIRAL NAILS		
B - E	6	SIDE(20.3)
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMW-1	MT20	4.0	6.0		
B	TMW-w	MT20	2.0	4.0		
C	TMW-1	MT20	4.0	6.0		
D	BMV1+P	MT20	3.0	4.0		
E	BMVWW-1	MT20	4.0	9.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER.

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	5-8	5-8
F	1018	0	0	0
D	1085	0	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	726	498/0	0/0	0/0	0/0	290/0	0/0
D	772	479/0	0/0	0/0	0/0	293/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.23 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.08 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.
FR-TO														
F-A	-965/0	0.0	0.0	0.05	(1)	7.81	A-E	0/1810	0.22	(1)				
A-G	-1708/0	-91.8	-91.8	0.28	(1)	6.23	E-B	-482/0	0.04	(1)				
G-B	-1708/0	-91.8	-91.8	0.28	(1)	6.23	E-C	0/1810	0.22	(1)				
B-C	-1708/0	-91.8	-91.8	0.08	(1)	6.25								
D-C	-707/0	0.0	0.0	0.04	(1)	7.81								
F-E	0/0	-43.5	-43.5	0.05	(4)	10.00								
E-H	0/0	-43.5	-43.5	0.22	(1)	10.00								
H-D	0/0	-43.5	-43.5	0.22	(1)	10.00								

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	3-0-12	-450	-450	---	FRONT	VERT	TOTAL	---	C1
G	1-0-12	-404	-404	---	TOP	VERT	TOTAL	---	C1
H	5-0-12	-452	-452	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***

GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.

LOADS WERE DERIVED FROM USER INPUT NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 21.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSI: TC=0.28/1.00 (A-B:1), BC=0.22/1.00 (D-E:1), WB=0.22/1.00 (A-E:1), SSI=0.16/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	818	354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.59 (C) (INPUT = 0.90)
JSI METAL= 0.21 (C) (INPUT = 1.00)

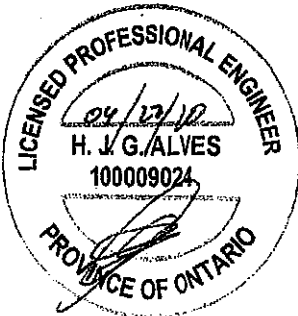


Structural component only
DWG# T-2007097 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408151	T35	2	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	
Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:20:01 2020 Page 2 ID:h2dfgC44wS_E2tqPs abzIRw-EO9R5nym13W447Oww8IKTxzhdFi xTUd8gz_1tzNCXS					

PLATES (table is in inches)
 JT TYPE PLATES W LEN Y X
 F BMV1+p MT20 3.0 4.0

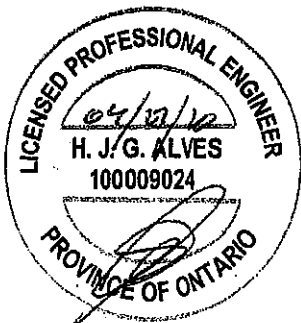


Structural component only
 DWG# T-2007097 312

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408151	G36	1	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:19:41 2020 Page 1
ID:h2dlgC44wS_E2tqP9_atzllRw-pXyvtvxDkw?yhw3lxxelk8KIBtVFSmhYZ7xyBzNCXm

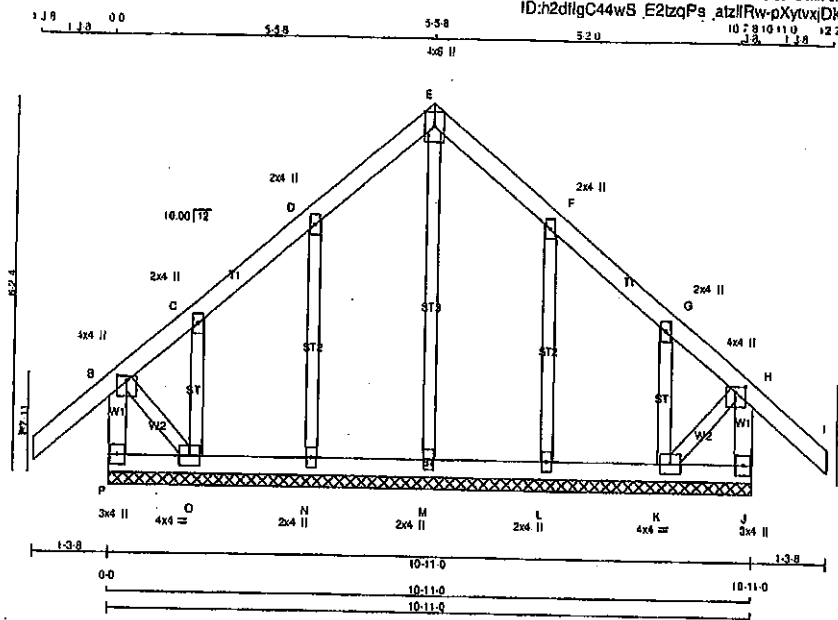

Scale = 1/8" = 1'-0"

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
P - B	2x4	DRY	No.2
A - E	2x4	DRY	No.2
E - I	2x4	DRY	No.2
J - H	2x4	DRY	No.2
P - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00
C, D, F, G					
C TMW+w	MT20	2.0	4.0		
E TTW+p	MT20	4.0	8.0	Edge	
H TMVW+p	MT20	4.0	4.0	1.00	2.00
J BMV1+p	MT20	3.0	4.0		
K BMW1-t	MT20	4.0	4.0		
L, M, N					
L BMW1+w	MT20	2.0	4.0		
O BMW1-t	MT20	4.0	4.0		
P BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO				FR-TO			
P-B	-274/0	0.0	0.0 0.03 (1)	M-E	-139/0	0.08 (1)	
A-B	0/41	-91.8	-91.8 0.13 (1)	N-D	-223/0	0.07 (1)	
B-C	-57/0	-91.8	-91.8 0.12 (1)	O-C	-75/0	0.01 (1)	
C-D	-4/0	-91.8	-91.8 0.05 (1)	L-F	-223/0	0.07 (1)	
D-E	-22/0	-91.8	-91.8 0.08 (1)	K-G	-75/0	0.01 (1)	
E-F	-22/0	-91.8	-91.8 0.08 (1)	S-O	0/20	0.00 (1)	
F-G	-4/0	-91.8	-91.8 0.12 (1)	K-H	0/20	0.00 (1)	
G-H	-57/0	-91.8	-91.8 0.12 (1)				
H-I	0/41	-91.8	-91.8 0.13 (1)				
J-H	-274/0	0.0	0.0 0.03 (1)				
P-O	0/0	-18.5	-18.5 0.01 (4)				
O-N	0/12	-18.5	-18.5 0.02 (4)				
N-M	0/7	-18.5	-18.5 0.02 (4)				
M-L	0/7	-18.5	-18.5 0.02 (4)				
L-K	0/12	-18.5	-18.5 0.02 (4)				
K-J	0/0	-18.5	-18.5 0.01 (4)				

TOTAL WEIGHT = 53 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.13/1.00 (H-E), BC=0.02/1.00 (K-L), WB=0.08/1.00 (E-M), SSI=0.08/1.00 (A-S)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX	MIN	MAX
MT20	618	354
	1667	788
	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.21 (B) (INPUT = 0.80)
JSI METAL = 0.12 (F) (INPUT = 1.00)

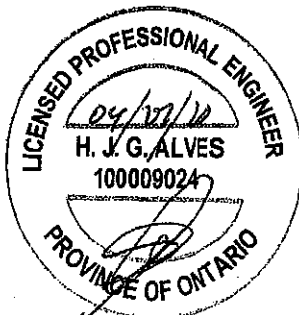

Structural component only
DWG# T-2007079

JOB NAME: 408152 TRUSS NAME: T40 QUANTITY: 1 PLY: 2 JOB DESC: GREEN PARK HOMES DRWG NO. Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Sat Apr 25 11:28:32 2020 Page 1
ID:17VF7aG0E03cRUj6X1jSkzIWKYK-0EA1x1sxZWS341YelZ2E8M8CTQSHDeTgR0niCQzNCOX
Scale = 1:57.3

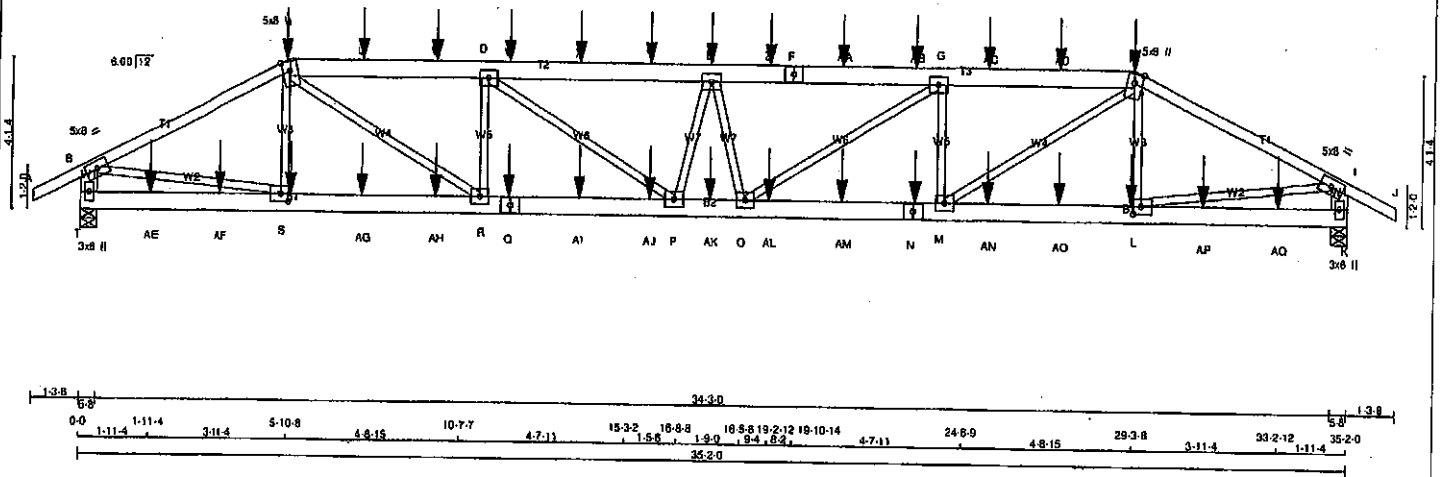

LUMBER	SIZE	DRY	NO.2	DESCR
A - C	2x4	DRY	No.2	SPF
C - F	2x6	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - J	2x6	DRY	No.2	SPF
T - B	2x4	DRY	No.2	SPF
K - I	2x6	DRY	No.2	SPF
T - Q	2x6	DRY	No.2	SPF
Q - N	2x6	DRY	No.2	SPF
N - K	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	SIDE(61.0)
H - J	12	SIDE(61.0)
C - F	12	SIDE(61.0)
F - H	12	SIDE(61.0)
T - B	12	TOP
K - I	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
T - Q	12	SIDE(183.1)
Q - N	12	SIDE(183.1)
N - K	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG	
T	3331	0	3331	0	5-8
K	3331	0	3331	0	5-8
UNFACTORED REACTIONS		1ST LOASE	MAX/MIN. COMPONENT REACTIONS		
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
T	2358	1644 / 0	0 / 0	0 / 0	812 / 0
K	2358	1644 / 0	0 / 0	0 / 0	812 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.87 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. FACTORED (LBS)	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	FR-TO	
A-B	0 / 28	-91.8	-91.8 0.07 (1)	S-C	-427 / 8
B-C	-5077 / 0	-91.8	-91.8 0.52 (1)	C-R	0 / 3083
C-U	-7106 / 0	-91.8	-91.8 0.23 (1)	R-D	-1585 / 0
U-V	-7106 / 0	-91.8	-91.8 0.23 (1)	O-G	0 / 1071
V-D	-7106 / 0	-91.8	-91.8 0.23 (1)	M-G	-1585 / 0
D-W	-7994 / 0	-91.8	-91.8 0.27 (1)	L-H	-427 / 8
W-X	-7994 / 0	-91.8	-91.8 0.27 (1)	B-S	0 / 4592
X-Y	-7994 / 0	-91.8	-91.8 0.27 (1)	L-I	0 / 4592
Y-E	-7994 / 0	-91.8	-91.8 0.27 (1)	D-P	0 / 1071
E-Z	-7994 / 0	-91.8	-91.8 0.27 (1)	M-H	0 / 3083
Z-F	-7994 / 0	-91.8	-91.8 0.27 (1)	P-E	-505 / 0
F-AA	-7994 / 0	-91.8	-91.8 0.27 (1)	E-O	-505 / 0
AA-AB	-7994 / 0	-91.8	-91.8 0.27 (1)		
AB-G	-7994 / 0	-91.8	-91.8 0.27 (1)		
G-AC	-7106 / 0	-91.8	-91.8 0.23 (1)		
AC-AD	-7106 / 0	-91.8	-91.8 0.23 (1)		
AD-H	-7106 / 0	-91.8	-91.8 0.23 (1)		
H-I	-5077 / 0	-91.8	-91.8 0.52 (1)		
I-J	0 / 28	-91.8	-91.8 0.07 (1)		
T-B	-3255 / 0	0.0	0.0 0.11 (1)		
K-I	-3255 / 0	0.0	0.0 0.11 (1)		

T-AE	0 / 0	-18.5	-18.5 0.06 (4)	10.00
AE-AF	0 / 0	-18.5	-18.5 0.06 (4)	10.00
AF-S	0 / 0	-18.5	-18.5 0.06 (4)	10.00
S-AG	0 / 4593	-18.5	-18.5 0.34 (1)	10.00
AG-AH	0 / 4593	-18.5	-18.5 0.34 (1)	10.00
AH-R	0 / 4593	-18.5	-18.5 0.34 (1)	10.00
R-Q	0 / 7105	-18.5	-18.5 0.52 (1)	10.00
Q-AI	0 / 7105	-18.5	-18.5 0.52 (1)	10.00
AI-AJ	0 / 7105	-18.5	-18.5 0.52 (1)	10.00
AJ-P	0 / 7105	-18.5	-18.5 0.52 (1)	10.00
P-AK	0 / 8119	-18.5	-18.5 0.56 (1)	10.00
AK-O	0 / 8119	-18.5	-18.5 0.56 (1)	10.00
O-AL	0 / 7105	-18.5	-18.5 0.52 (1)	10.00
AL-AM	0 / 7105	-18.5	-18.5 0.52 (1)	10.00
AM-N	0 / 7105	-18.5	-18.5 0.52 (1)	10.00
N-M	0 / 7105	-18.5	-18.5 0.52 (1)	10.00
M-AN	0 / 4593	-18.5	-18.5 0.34 (1)	10.00
AN-AO	0 / 4593	-18.5	-18.5 0.34 (1)	10.00
AO-L	0 / 4593	-18.5	-18.5 0.34 (1)	10.00
L-AP	0 / 0	-18.5	-18.5 0.06 (4)	10.00
AP-AQ	0 / 0	-18.5	-18.5 0.06 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
BOT CH. LL = 8.0 PSF
DL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/989 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/989 (0.38")

CSI: TC=0.52/1.00 (H-I:1), BC=0.58/1.00 (O-P:1), WB=0.57/1.00 (B-S:1), SS=0.18/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 018 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (S) (INPUT = 0.90)
JSI METAL= 0.84 (N) (INPUT = 1.00)

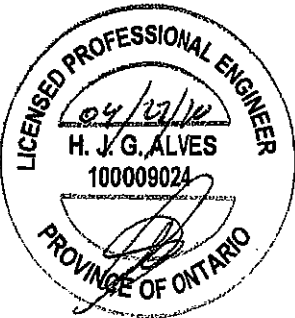

Structural component only
DWG# T-2007107 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	T40	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:32 2020 Page 2
ID:ITvF7aG0E03cRU16X1JSrkzWYK-0FA1x1sxZWS341Ye1Z2E6M6CTQSHDgTgR0niCQzNCOX

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	5.0	8.0		
C	TTWW+m	MT20	5.0	8.0	Edge	
D, E, G						
D	TMVW-1	MT20	5.0	8.0		
F	TS-1	MT20	5.0	6.0		
H	TTWW+m	MT20	5.0	8.0	Edge	
I	TMVW-1	MT20	5.0	8.0		
K	BMV1+p	MT20	3.0	6.0		
L	BMVW-1	MT20	5.0	6.0	2.50	2.50
M, O, P, R						
M	BMVW-1	MT20	5.0	6.0		
N	BS-1	MT20	5.0	6.0		
Q	BS-1	MT20	5.0	6.0		
S	BMVW-1	MT20	5.0	6.0	2.50	2.50
T	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING

TOTAL LOAD CASES: (4)


CHORDS				WEBS			
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX	MAX. MEMB. FORCE (LBS)	MAX. FACTORED UNBRAC (LBS)	MAX. FACTORED CS1 (LC)	MAX. FACTORED CS1 (LC)
FR-TO							
AQ-K	0.0						
		FROM TO					
			-18.5	-18.5	0.06 (4)	10.00	

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-438	-438	---	FRONT	VERT	TOTAL	---	C1
E	17-7-0	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	29-3-8	-438	-438	---	FRONT	VERT	TOTAL	---	C1
L	29-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
N	23-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Q	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
S	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
U	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	19-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	21-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	1-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AF	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	15-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	17-7-0	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AL	19-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AM	21-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AN	23-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AO	25-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AP	27-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AQ	33-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

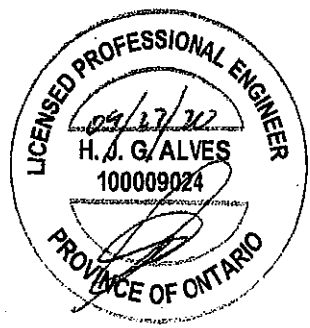


Structural component only
DWG# T-2007107 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408152	T40Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 26 11:29:34 2020 Page 1
ID:7vF7aG0E03cRUj6X1SkzIwYK-ydH2MiuB57mK311?_4iCnCV7E2GhUJzKGPgJzNCOV

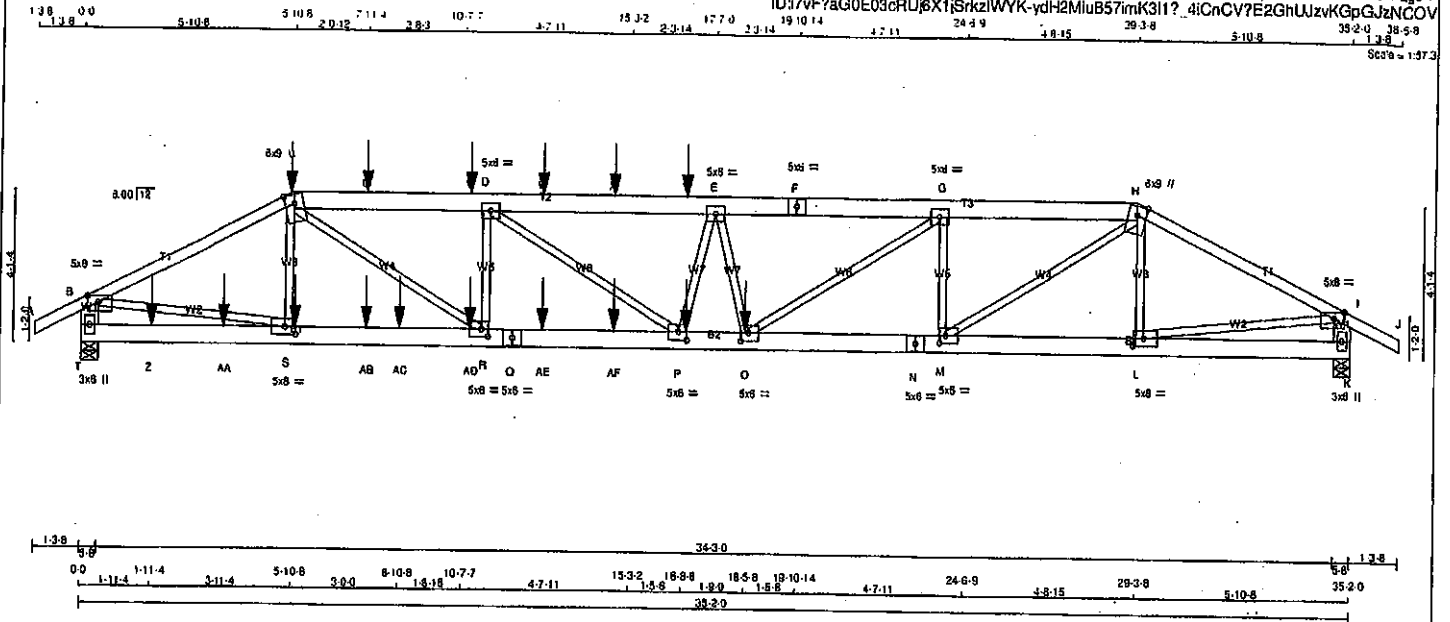

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - F	2x8	DRY	No.2	SPF		
F - H	2x8	DRY	No.2	SPF		
H - J	2x4	DRY	No.2	SPF		
T - B	2x8	DRY	No.2	SPF		
K - I	2x8	DRY	No.2	SPF		
T - Q	2x8	DRY	No.2	SPF		
Q - N	2x8	DRY	No.2	SPF		
N - K	2x8	DRY	No.2	SPF		

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C 1	12	SIDE(61.0)
H-J 1	12	TOP
C-F 2	12	SIDE(61.0)
F-H 2	12	TOP
T-B 2	12	TOP
K-I 2	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
T-Q 2	12	SIDE(163.1)
Q-N 2	12	SIDE(0.0)
N-K 2	12	TOP
WEBS: (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLYS FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	DOWN	UP	IN-SX
T	4474	0	4474	0
K	3775	0	3775	0

UNFACTORED REACTIONS	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
T	3182	2088 / 0	0 / 0	0 / 0	1073 / 0	0 / 0
K	2865	1772 / 0	0 / 0	0 / 0	893 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.19 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING		TOTAL LOAD CASES: (4)						
CHORDS			WEBS					
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO			FR-TO			
A-B	0 / 28	-91.8	-91.8	0.07 (1)	10.00	S-C	-384 / 25	0.05 (1)
B-C	-7163 / 0	-91.8	-91.8	0.71 (1)	3.19	C-R	0 / 4887	0.58 (1)
C-U	-10299 / 0	-91.8	-91.8	0.32 (1)	3.82	R-D	-2057 / 0	0.25 (1)
U-V	-10299 / 0	-91.8	-91.8	0.32 (1)	3.82	O-G	0 / 3811	0.45 (1)
V-D	-10299 / 0	-91.8	-91.8	0.32 (1)	3.82	M-H	-2637 / 0	0.32 (1)
D-W	-12012 / 0	-91.8	-91.8	0.45 (1)	3.27	L-G	-816 / 0	0.08 (1)
W-X	-12012 / 0	-91.8	-91.8	0.45 (1)	3.27	B-S	0 / 6479	0.80 (1)
X-Y	-12012 / 0	-91.8	-91.8	0.45 (1)	3.27	L-I	0 / 5333	0.68 (1)
Y-E	-12012 / 0	-91.8	-91.8	0.45 (1)	3.27	D-P	0 / 2066	0.26 (1)
E-F	-12381 / 0	-91.8	-91.8	0.40 (1)	3.28	M-H	0 / 4950	0.61 (1)
F-G	-12381 / 0	-91.8	-91.8	0.40 (1)	3.28	P-E	-1110 / 0	0.14 (1)
G-H	-9368 / 0	-91.8	-91.8	0.25 (1)	3.84	E-O	0 / 383	0.05 (1)
H-I	-5896 / 0	-91.8	-91.8	0.59 (1)	3.58			
I-J	0 / 28	-91.8	-91.8	0.07 (1)	10.00			
T-B	-4430 / 0	0.0	0.0	0.16 (1)	6.82			
K-I	-3716 / 0	0.0	0.0	0.13 (1)	7.31			

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-438	-438	---	---	BACK	VERT	TOTAL	---	C1
O	18-5-8	-2436	-2436	---	---	BACK	VERT	TOTAL	---	C1
P	18-9-12	-17	-17	---	---	BACK	VERT	TOTAL	---	C1
S	5-11-4	-26	-26	---	---	BACK	VERT	TOTAL	---	C1
U	7-11-4	-110	-110	---	---	BACK	VERT	TOTAL	---	C1
V	10-9-12	-82	-82	---	---	BACK	VERT	TOTAL	---	C1
W	12-9-12	-82	-82	---	---	BACK	VERT	TOTAL	---	C1

TOTAL WEIGHT = 2 X 170 = 341 b

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/989 (0.31")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/740 (0.57")

CSI: TC=0.71/1.00 (B-C); BC=0.91/1.00 (O-P); WB=0.80/1.00 (B-S); SSI=0.15/1.00 (R-S);

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1887 788 1987 1658

PLATE PLACEMENT TOL. = 0.260 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (S) (INPUT = 0.90)
JSI METAL= 0.93 (N) (INPUT = 1.00)



Structural component only
DWG# T-2007108

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408152	T40Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:34 2020 Page 2
ID: i7vF?aG0E03cRUj6X1S/kzlWYK-ydH2MuB57imK3it? 4iCnCV?E2GhUJzvKGnGUzNCOV

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	8.0	2.00	3.50
C	TTWW-m	MT20	6.0	9.0	Edge	
D, E, G						
D	TMWV-l	MT20	5.0	6.0		
F	TS-l	MT20	5.0	6.0		
H	TTWW-m	MT20	6.0	9.0	Edge	
I	TMWV-p	MT20	5.0	8.0	2.00	3.50
K	BMV1-p	MT20	3.0	6.0		
L	BMWV-l	MT20	5.0	6.0	2.50	3.50
M	BMWV-l	MT20	5.0	6.0	2.50	2.00
N	BS-l	MT20	5.0	6.0		
O	BMWV-l	MT20	5.0	6.0	2.75	2.75
P	BMWV-l	MT20	5.0	6.0	2.75	2.75
Q	BS-l	MT20	5.0	6.0		
R	BMWV-l	MT20	5.0	6.0	2.50	2.00
S	BMWV-l	MT20	5.0	6.0	2.50	3.50
T	BMV1-p	MT20	3.0	6.0		


Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
X	14-9-12	-82	-82	---	BACK	VERT	TOTAL	---	C1
Y	16-9-12	-82	-82	---	BACK	VERT	TOTAL	---	C1
Z	1-11-4	-25	-25	---	BACK	VERT	TOTAL	---	C1
AA	3-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AB	7-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AC	8-10-8	-639	-639	---	BACK	VERT	TOTAL	---	C1
AD	10-9-12	-17	-17	---	BACK	VERT	TOTAL	---	C1
AE	12-9-12	-17	-17	---	BACK	VERT	TOTAL	---	C1
AF	14-9-12	-17	-17	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

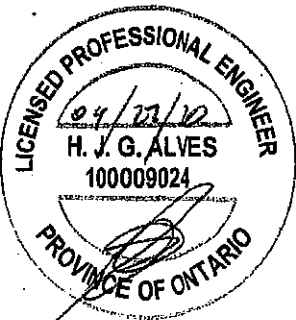


Structural component only
DWG# T-2007108

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	T41	2	1	GREEN PARK HOMES	
TRUSS DESC.					

Tamareck Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 11:29:35 2020 Page 1
ID:7v7aG0E03cRUI6X1jSkzIWK-QprQazvprQdxDHDYhbxk_kd2aSiQx967_0NpZNCOL

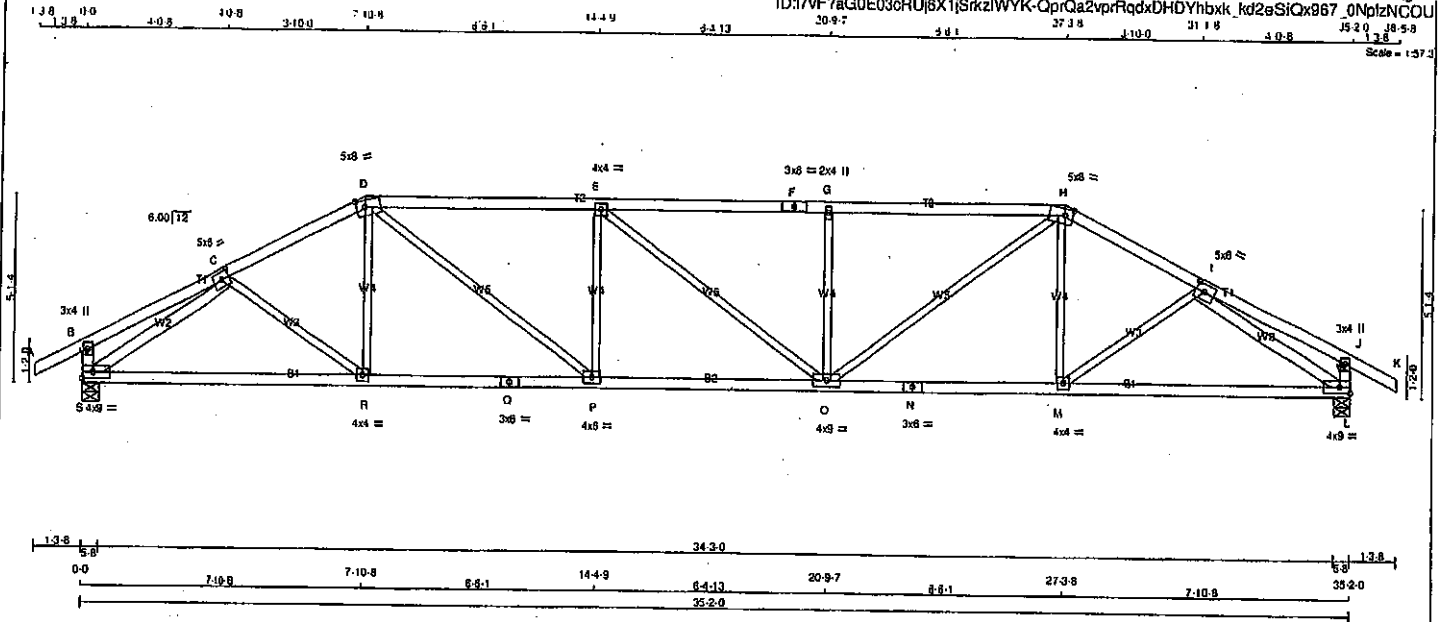

TOTAL WEIGHT = 2 X 139 = 278 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMV+p	MT20	3.0	4.0	
C TMWW-t	MT20	5.0	8.0	2.50 2.75
D TTTW-m	MT20	5.0	8.0	2.25 2.75
E TMWW-t	MT20	4.0	4.0	
F TS-t	MT20	3.0	8.0	
G TMW+w	MT20	2.0	4.0	
H TTTW-m	MT20	5.0	8.0	2.25 2.75
I TMWW-t	MT20	5.0	8.0	2.50 2.75
J TMV+p	MT20	3.0	4.0	
L BMVW-t	MT20	4.0	9.0	Edge
M BMWW-t	MT20	4.0	4.0	
N BS-t	MT20	3.0	8.0	
O BMWWW-t	MT20	4.0	9.0	
P BMWW-t	MT20	4.0	8.0	
Q BS-t	MT20	3.0	8.0	
R BMWW-t	MT20	4.0	4.0	
S BMVW-t	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED	MAXIMUM FACTORED	INPUT	REQD			
	GROSS REACTION	GROSS REACTION	BRG	BRG			
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
S	2063	0	2063	0	0	5-8	5-8
L	2063	0	2063	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LOASE MAX/MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.94 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	WEBS	MEMB.	MAX. FACTORED	MAX	
	FORCE	VERT. LOAD	CS1 (LC)		FORCE	CS1 (LC)	
FR-TO	FROM TO	CS1 (LC)	UNBRAC	FR-TO	FROM TO	CS1 (LC)	
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	C-R	0 / 93
B-C	0 / 18	-91.8	-91.8	0.20 (1)	10.00	R-D	0 / 121
C-D	-2799 / 0	-91.8	-91.8	0.32 (1)	3.88	D-P	0 / 1267
D-E	-3508 / 0	-91.8	-91.8	0.35 (1)	2.94	P-E	-643 / 0
E-F	-3507 / 0	-91.8	-91.8	0.35 (1)	2.94	E-O	-2 / 0
F-G	-3507 / 0	-91.8	-91.8	0.35 (1)	2.94	O-G	-643 / 0
G-H	-3507 / 0	-91.8	-91.8	0.35 (1)	2.94	H-O	0 / 1266
H-I	-2799 / 0	-91.8	-91.8	0.32 (1)	3.88	M-H	0 / 121
I-J	0 / 16	-91.8	-91.8	0.20 (1)	10.00	M-I	0 / 93
J-K	0 / 28	-91.8	-91.8	0.12 (1)	10.00	S-C	-2974 / 0
S-B	-270 / 0	0.0	0.0	0.03 (1)	7.81	I-L	-2974 / 0
L-J	-270 / 0	0.0	0.0	0.03 (1)	7.81		
S-R	0 / 2417	-18.5	-18.5	0.53 (1)	10.00		
R-Q	0 / 2489	-18.5	-18.5	0.54 (1)	10.00		
Q-P	0 / 2489	-18.5	-18.5	0.54 (1)	10.00		
P-O	0 / 3509	-18.5	-18.5	0.64 (1)	10.00		
O-N	0 / 2489	-18.5	-18.5	0.54 (1)	10.00		
N-M	0 / 2489	-18.5	-18.5	0.54 (1)	10.00		
M-L	0 / 2417	-18.5	-18.5	0.53 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/899 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/899 (0.41")

CS1: TC=0.85/1.00 (D-E), BC=0.84/1.00 (O-P), WB=0.83/1.00 (H-L), SS=0.28/1.00 (D-E)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (L) (INPUT = 0.90)
JSI METAL= 0.77 (N) (INPUT = 1.00)

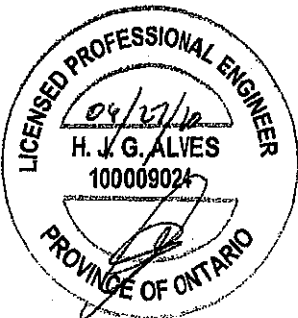

Structural component only
DWG# T-2007109

JOB NAME 408152	TRUSS NAME T42	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

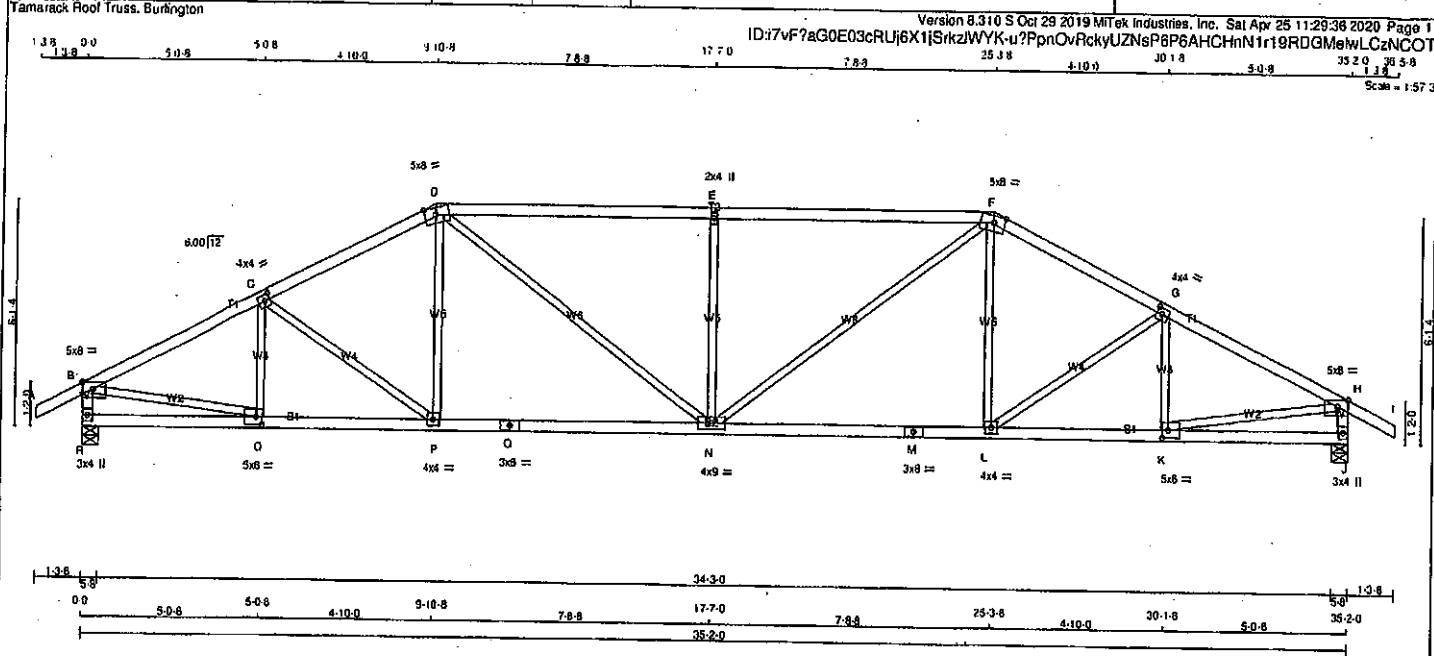

LUMBER			
N. L. G. A. RULES	SIZE	DRY	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)			
JT TYPE	PLATES	W	LEN Y X
B	TMVW-p	MT20	5.0 8.0 Edge 3.50
C	TMVW-t	MT20	4.0 4.0 2.00 1.75
D	TTWV-m	MT20	5.0 8.0 2.25 3.75
E	TMVW-w	MT20	2.0 4.0
F	TTWV-m	MT20	5.0 8.0 2.25 3.75
G	TMVW-t	MT20	4.0 4.0 2.00 1.75
H	TMVW-p	MT20	5.0 8.0 Edge 3.50
J	BMV1-p	MT20	3.0 4.0
K	BMVW-t	MT20	5.0 8.0 2.50 2.00
L	BMVW-t	MT20	4.0 4.0
M	BS-t	MT20	3.0 4.0
N	BMVW-t	MT20	4.0 4.0
O	BS-t	MT20	3.0 4.0
P	BMVW-t	MT20	4.0 4.0
Q	BMVW-t	MT20	5.0 8.0 2.50 2.00
R	BMV1-p	MT20	3.0 4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	DOWN	IN-SX	IN-SX
R 2063 0	2063 0	5-8	5-8
J 2063 0	2063 0	5-8	5-8

UNFACTORED REACTIONS			
1ST LCASE	MAX. MIN. COMPONENT REACTIONS		
JT COMBINED	SNOW	LIVE	PERM. LIVE
R 1457 989 / 0	0 / 0	0 / 0	488 / 0
J 1457 989 / 0	0 / 0	0 / 0	488 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.78 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO			
A-B	0 / 28	-91.8 -91.8 0.12 (1)	10.00
B-C	-2834 / 0	-91.8 -91.8 0.39 (1)	3.81
C-D	-2887 / 0	-91.8 -91.8 0.37 (1)	3.91
D-E	-3060 / 0	-91.8 -91.8 0.97 (1)	2.78
E-F	-3060 / 0	-91.8 -91.8 0.97 (1)	2.78
F-G	-2887 / 0	-91.8 -91.8 0.37 (1)	3.91
G-H	-2834 / 0	-91.8 -91.8 0.12 (1)	10.00
H-I	0 / 28	-91.8 -91.8 0.39 (1)	3.81
I-J	-2018 / 0	0.0 0.0 0.20 (1)	5.94
J-K	-2018 / 0	0.0 0.0 0.20 (1)	5.94
K-L	0 / 0	-18.5 -18.5 0.10 (4)	10.00
L-M	0 / 2555	-18.5 -18.5 0.61 (1)	10.00
M-N	0 / 2388	-18.5 -18.5 0.49 (1)	10.00
N-O	0 / 2388	-18.5 -18.5 0.49 (1)	10.00
O-P	0 / 2388	-18.5 -18.5 0.49 (1)	10.00
P-Q	0 / 2388	-18.5 -18.5 0.49 (1)	10.00
Q-R	0 / 2555	-18.5 -18.5 0.61 (1)	10.00
R-S	0 / 0	-18.5 -18.5 0.10 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/999 (0.17")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/999 (0.34")
CSI: TC=0.97/1.00 (D-E:1), BC=0.51/1.00 (K-L:1), WB=0.58/1.00 (H-K:1), SSI=0.34/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1887
	618	354	1887

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.87 (D) (INPUT = 0.90)
JSI METAL = 0.75 (O) (INPUT = 1.00)

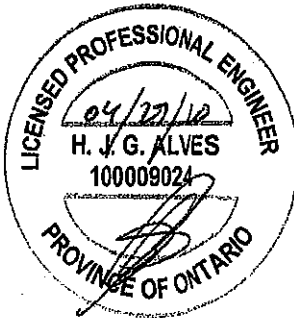

Structural component only
DWG# T-2007110

JOB NAME 408152	TRUSS NAME T43	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 11:29:37 2020 Page 1
 ID: i7vF7aG0E03cRUj8X1jSkzIWK-MCzB_kw3N24LBWQcg6dPpPq2FRBXutKPbIVTleZNCOS
 Scale = 1:57.3

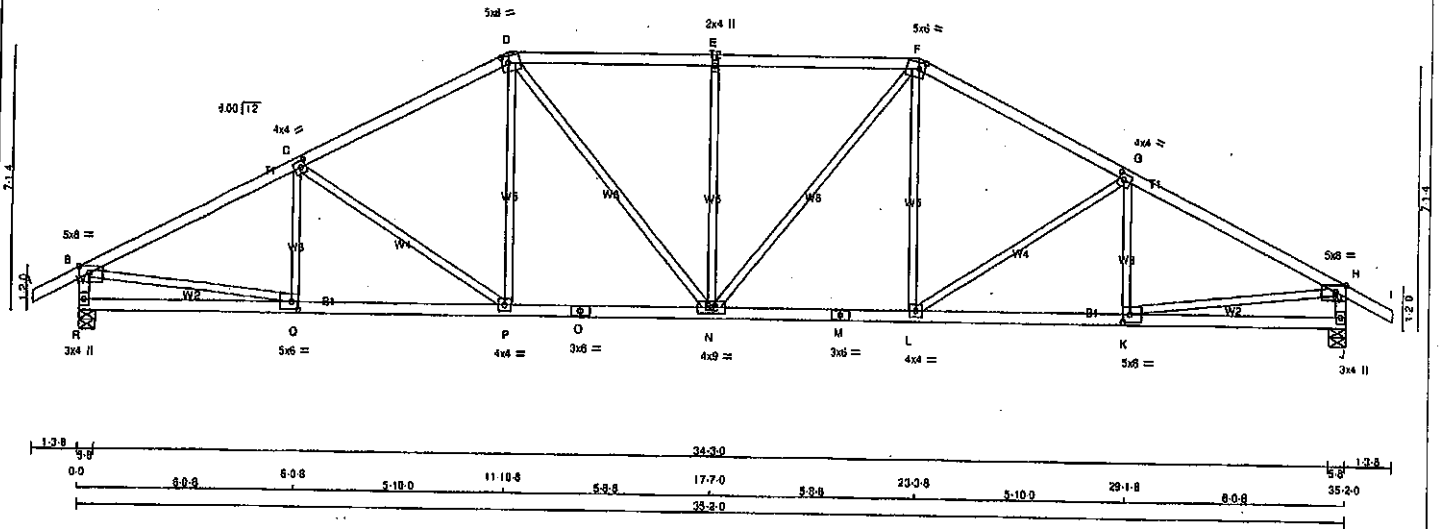

LUMBER			
N. L. Q. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - R	2x4	DRY	No.2
R - H	2x4	DRY	No.2
H - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
	FACTORED	MAXIMUM FACTORED	INPUT	REQ'D					
	GROSS REACTION	GROSS REACTION	BRG	BRG					
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
R	2083	0	2083	0	0	5-8	5-8		
J	2083	0	2083	0	0	5-8	5-8		
UNFACTORED REACTIONS									
1ST LCASE	MAX./MIN. COMPONENT REACTIONS								
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
R	1467	989 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0		
J	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0		
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J									
BRACING									
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.68 FT.									
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.									
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.									
LOADING									
TOTAL LOAD CASES: (4)									

CHORDS									
MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED	MAX
	(LBS)	(PLF)			CSI (L/C)	UNBRAC		(LBS)	CSI (L/C)
FR-TO		FROM	TO			LENGTH	FR-TO		
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00		Q-C	-255 / 12	0.07 (1)
B-C	-2889 / 0	-91.8	-91.8	0.59 (1)	3.68		C-P	-435 / 0	0.42 (1)
C-D	-2539 / 0	-91.8	-91.8	0.52 (1)	3.63		P-D	0 / 350	0.08 (1)
D-E	-2559 / 0	-91.8	-91.8	0.48 (1)	3.65		D-N	0 / 482	0.11 (1)
E-F	-2559 / 0	-91.8	-91.8	0.48 (1)	3.65		N-E	-641 / 0	0.56 (1)
F-G	-2539 / 0	-91.8	-91.8	0.52 (1)	3.63		E-F	0 / 482	0.11 (1)
G-H	-2889 / 0	-91.8	-91.8	0.59 (1)	3.68		F-G	0 / 350	0.08 (1)
H-I	0 / 28	-91.8	-91.8	0.12 (1)	10.00		G-H	-435 / 0	0.42 (1)
I-J	-2014 / 0	0.0	0.0	0.20 (1)	5.95		H-I	-255 / 12	0.07 (1)
J-H	-2014 / 0	0.0	0.0	0.20 (1)	5.95		I-J	0 / 2635	0.59 (1)
R-Q	0 / 0	-18.5	-18.5	0.15 (4)	10.00		K-H	0 / 2635	0.59 (1)
Q-P	0 / 2609	-18.5	-18.5	0.49 (1)	10.00				
P-O	0 / 2249	-18.5	-18.5	0.43 (1)	10.00				
O-N	0 / 2249	-18.5	-18.5	0.43 (1)	10.00				
N-M	0 / 2249	-18.5	-18.5	0.43 (1)	10.00				
M-L	0 / 2249	-18.5	-18.5	0.43 (1)	10.00				
L-K	0 / 2609	-18.5	-18.5	0.49 (1)	10.00				
K-J	0 / 0	-18.5	-18.5	0.15 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 0.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/999 (0.15")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/999 (0.28")

CSI: TC=0.58/1.00 (G-H:1), BC=0.49/1.00 (K-L:1), WB=0.59/1.00 (B-Q:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP (DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (C) (INPUT = 0.90)
JSI METAL = 0.69 (M) (INPUT = 1.00)

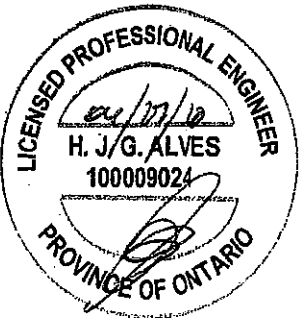

Structural component only
 DWG# T-2007111

JOB NAME 408152	TRUSS NAME T44	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:28:38 2020 Page 1	
ID:7VF7aG0E03cRUj6X1ISrkziWYK-rOXZC4x8MCCog?oEq9eMMA6rWEdKWYqyF1P4zNGOR				35 2 0 38 5 8 1 3 8	
Scale = 1:50.0					

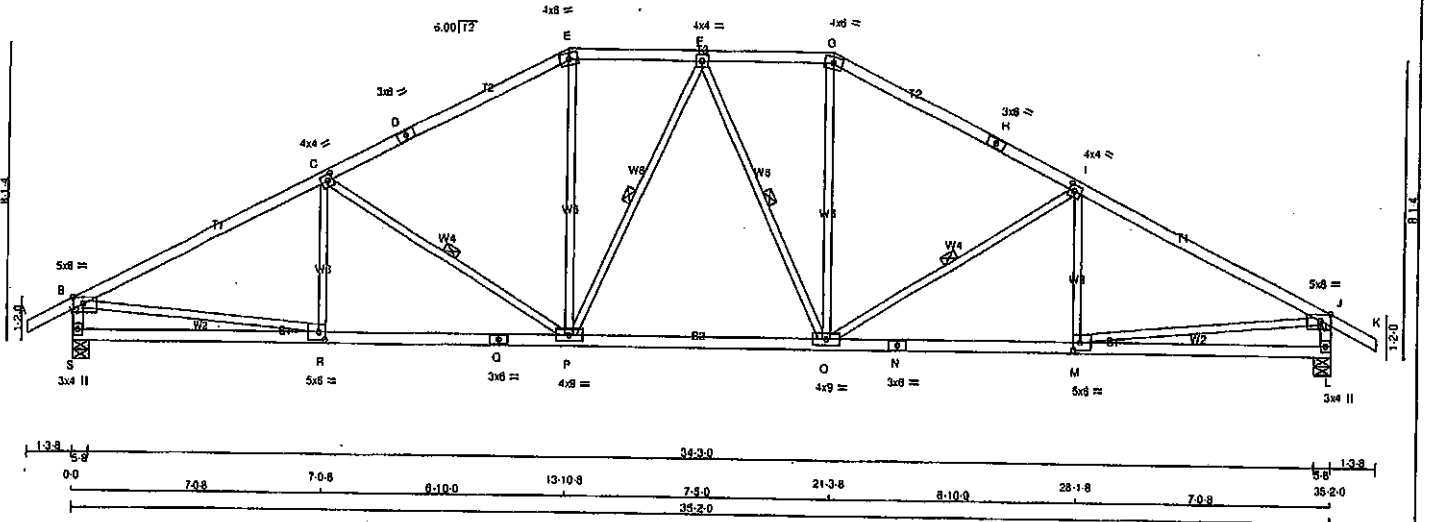

LUMBER			
N. L. G. A. RULES	SIZE	DESCR.	SPF
CHORDS			
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMWW-p	MT20	5.0	8.0	Edge	3.50
C TMWW-t	MT20	4.0	4.0	2.00	1.75
D TS-t	MT20	3.0	6.0		
E TTW-m	MT20	4.0	8.0		
F TMWW-t	MT20	4.0	4.0		
G TTW-m	MT20	4.0	8.0		
H TS-t	MT20	3.0	8.0		
I TMWW-t	MT20	4.0	4.0	2.00	1.75
J TMWW-p	MT20	5.0	8.0	Edge	3.50
L BMV1-p	MT20	3.0	4.0		
M BMWW-t	MT20	5.0	8.0	2.50	2.25
N BS-t	MT20	3.0	6.0		
O BMWWW-t	MT20	4.0	9.0		
P BMWWW-t	MT20	4.0	9.0		
Q BS-t	MT20	3.0	8.0		
R BMWW-t	MT20	5.0	8.0	2.50	2.25
S BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
S	2083	0	2083	0	5-8
L	2083	0	2083	0	5-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX	MIN	COMPONENT REACTIONS	
S	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
L	1457	889 / 0	0 / 0	0 / 0	0 / 0
L	1457	889 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-P, F-P, F-O, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO				FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	R-C	-182 / 52	0.08 (1)
B-C	-2908 / 0	-91.8	-91.8 0.83 (1)	3.25	C-P	-637 / 0	0.29 (1)
C-D	-2373 / 0	-91.8	-91.8 0.72 (1)	3.66	P-E	0 / 674	0.15 (1)
D-E	-2373 / 0	-91.8	-91.8 0.72 (1)	3.66	F-F	-222 / 0	0.11 (1)
E-F	-2100 / 0	-91.8	-91.8 0.19 (1)	4.53	F-O	-222 / 0	0.11 (1)
F-G	-2100 / 0	-91.8	-91.8 0.19 (1)	4.53	O-G	0 / 674	0.15 (1)
G-H	-2373 / 0	-91.8	-91.8 0.72 (1)	3.66	O-I	-637 / 0	0.29 (1)
H-I	-2373 / 0	-91.8	-91.8 0.72 (1)	3.66	M-I	-182 / 52	0.08 (1)
I-J	-2908 / 0	-91.8	-91.8 0.83 (1)	3.25	B-R	0 / 2649	0.60 (1)
J-K	0 / 28	-91.8	-91.8 0.12 (1)	10.00	M-J	0 / 2649	0.60 (1)
S-B	-2008 / 0	0.0	0.0 0.20 (1)	5.96			
L-J	-2008 / 0	0.0	0.0 0.20 (1)	5.96			
S-R	0 / 0	-18.5	-18.5 0.20 (4)	10.00			
R-Q	0 / 2630	-18.5	-18.5 0.52 (1)	10.00			
Q-P	0 / 2630	-18.5	-18.5 0.52 (1)	10.00			
P-O	0 / 2193	-18.5	-18.5 0.45 (1)	10.00			
O-N	0 / 2630	-18.5	-18.5 0.52 (1)	10.00			
N-M	0 / 2630	-18.5	-18.5 0.52 (1)	10.00			
M-L	0 / 0	-18.5	-18.5 0.20 (4)	10.00			

TOTAL WEIGHT = 2 X 145 = 291 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN PLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/999 (0.14")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/999 (0.30")

CSI: TC=0.89/1.00 (I-J:1), BC=0.52/1.00 (M-O:1),
WB=0.60/1.00 (B-R:1), SSI=0.28/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1858


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (M) (INPUT = 0.90)
JSI METAL = 0.79 (N) (INPUT = 1.00)

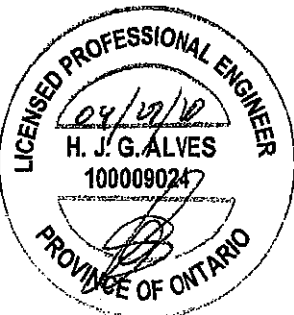

Structural component only
DWG# T-2007112

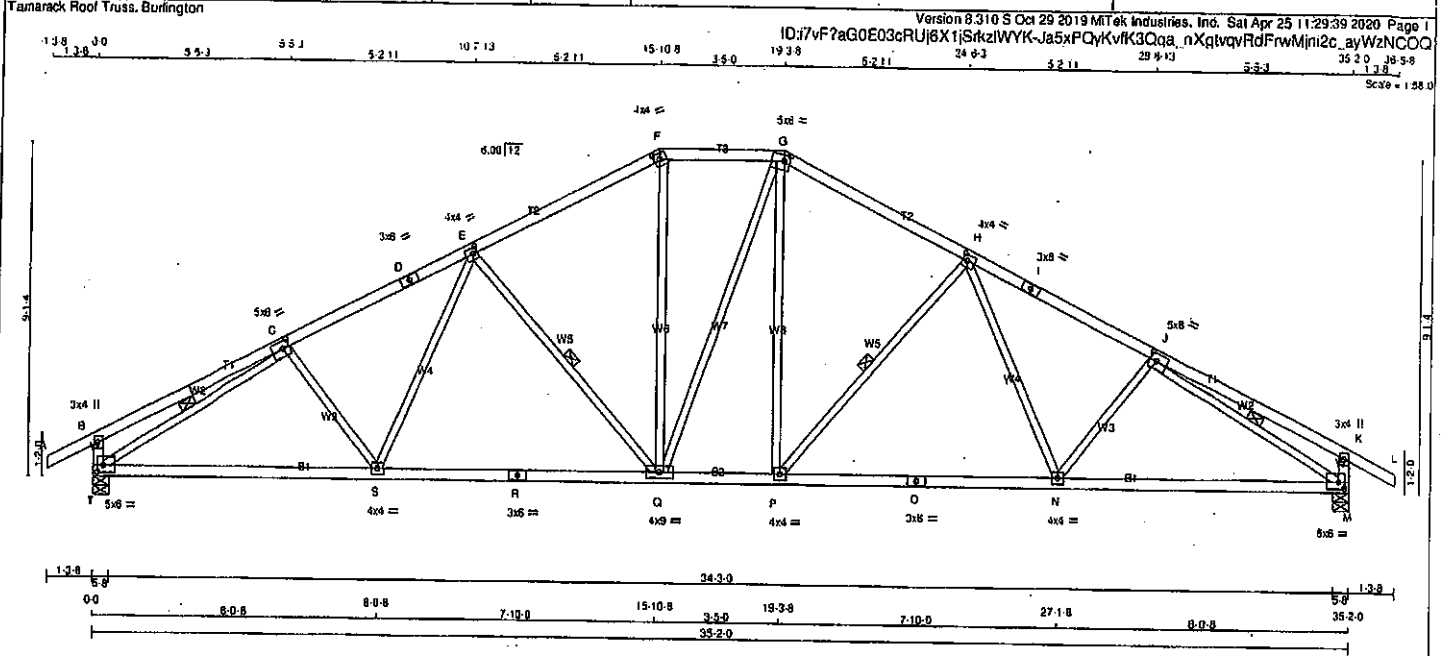

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
G - H	2x4	DRY	No.2	SPF
I - J	2x4	DRY	No.2	SPF
K - L	2x4	DRY	No.2	SPF
M - N	2x4	DRY	No.2	SPF
O - P	2x4	DRY	No.2	SPF
Q - R	2x4	DRY	No.2	SPF
S - T	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-1	MT20	5.0	6.0	2.50	2.25
D	TS-1	MT20	3.0	6.0		
E	TMWW-1	MT20	4.0	4.0	2.00	1.50
F	TTW-h	MT20	4.0	4.0	2.00	1.75
G	TTWW-m	MT20	5.0	6.0	2.00	2.00
H	TMWW-1	MT20	4.0	4.0	2.00	1.50
I	TS-1	MT20	3.0	6.0		
J	TMWW-1	MT20	5.0	6.0	2.50	2.25
K	TMV+p	MT20	3.0	4.0		
M	BMVW-1	MT20	5.0	6.0	2.25	2.00
N, P, S						
N	BMWW-1	MT20	4.0	4.0		
O	BS-1	MT20	3.0	6.0		
Q	BMVWW-1	MT20	4.0	9.0		
R	BS-1	MT20	3.0	6.0		
T	BMVW-1	MT20	5.0	6.0	2.25	2.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT. 2063	DOWN 2063	0	5-8
T	0	0	0	5-8
M	2063	0	0	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED SNOW LIVE PERM. LIVE WIND DEAD SOIL
T	1457 869 / 0 0 / 0 0 / 0 488 / 0 0 / 0
M	1457 869 / 0 0 / 0 0 / 0 488 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.88 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-Q, H-P, C-T, J-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 28	-91.8 -91.8	0.12 (1)	10.00	C-S	-110 / 37	0.04 (1)
B-C	0 / 19	-91.8 -91.8	0.32 (1)	10.00	S-E	0 / 276	0.08 (1)
C-D	-2759 / 0	-91.8 -91.8	0.40 (1)	3.88	E-Q	-891 / 0	0.31 (1)
D-E	-2759 / 0	-91.8 -91.8	0.40 (1)	3.88	Q-F	0 / 813	0.14 (1)
E-F	-2167 / 0	-91.8 -91.8	0.38 (1)	4.30	F-G	0 / 4	0.00 (1)
F-G	-1925 / 0	-91.8 -91.8	0.18 (1)	4.71	P-G	0 / 609	0.14 (1)
G-H	-2166 / 0	-91.8 -91.8	0.38 (1)	4.30	P-H	-892 / 0	0.31 (1)
H-I	-2760 / 0	-91.8 -91.8	0.40 (1)	3.88	H-N	0 / 276	0.08 (1)
I-J	-2760 / 0	-91.8 -91.8	0.40 (1)	3.88	N-J	-110 / 37	0.04 (1)
J-K	0 - 19	-91.8 -91.8	0.32 (1)	10.00	T-C	-3040 / 0	0.85 (1)
K-L	0 / 28	-91.8 -91.8	0.12 (1)	10.00	J-M	-3041 / 0	0.85 (1)
T-B	-326 / 0	0.0 0.0	0.03 (1)	7.81			
M-K	-326 / 0	0.0 0.0	0.03 (1)	7.81			
T-S	0 / 2536	-18.5 -18.5	0.55 (1)	10.00			
S-R	0 / 2362	-18.5 -18.5	0.53 (1)	10.00			
R-Q	0 / 2362	-18.5 -18.5	0.53 (1)	10.00			
Q-P	0 / 1924	-18.5 -18.5	0.40 (1)	10.00			
P-O	0 / 2362	-18.5 -18.5	0.53 (1)	10.00			
O-N	0 / 2362	-18.5 -18.5	0.53 (1)	10.00			
N-M	0 / 2537	-18.5 -18.5	0.56 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")

CALCULATED VERT. DEFL. (LL) = L/999 (0.15")

ALLOWABLE DEFL. (TL) = L/360 (1.17")

CALCULATED VERT. DEFL. (TL) = L/999 (0.32")

CSI: TC=0.40/1.00 (H-J:1), BC=0.56/1.00 (M-N:1), WB=0.85/1.00 (J-M:1), SS=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION

(PSI)	(PL)	(PL)	
MAX MIN MAX MIN MAX MIN			
MT20	618	354	1897
	788	1987	1898

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (M) (INPUT = 0.90)

JSI METAL = 0.83 (O) (INPUT = 1.00)




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408152	T46	6	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:41 2020 Page 1

ID:7vF7aG0E03cRUJ8Xf1SkrzWYK-FzCiq6zaRHong8kNwyl_F_md2XrqIH7WwTh0PzNCOO

Scale = 1/8" = 1'-0"

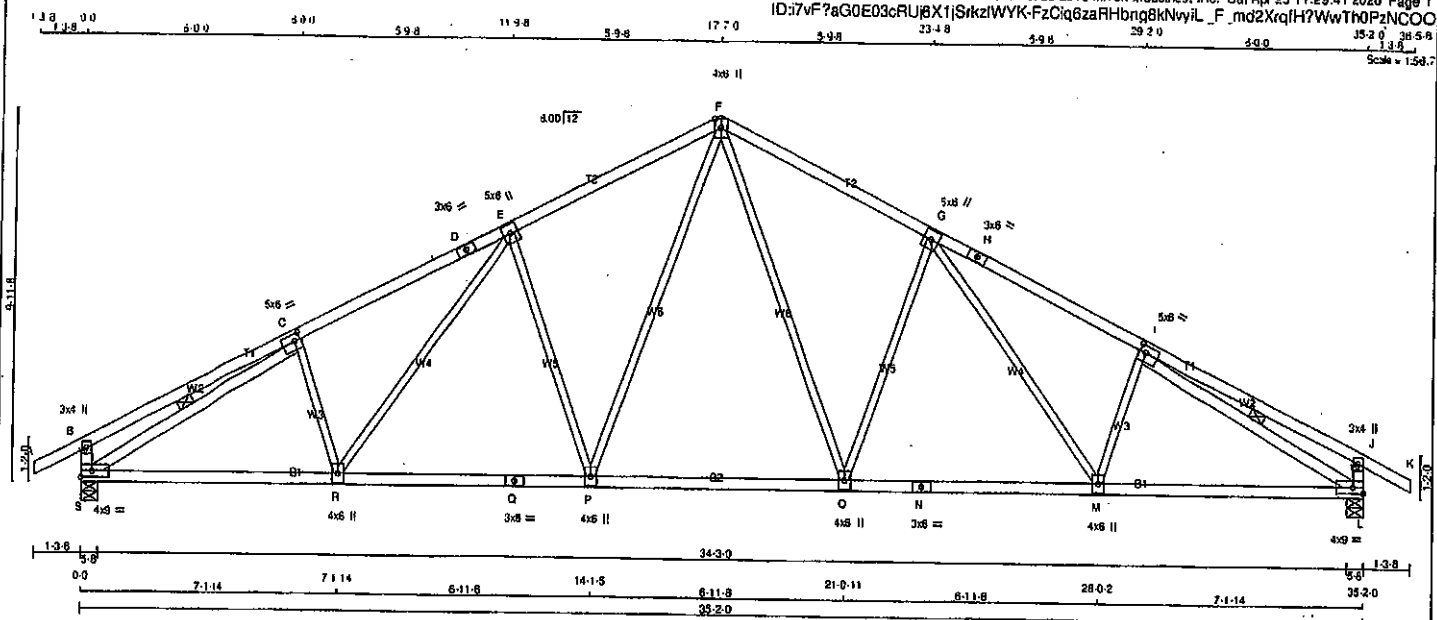

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4 DRY	No.2	SPF
D - F	2x4 DRY	No.2	SPF
F - H	2x4 DRY	No.2	SPF
H - K	2x4 DRY	No.2	SPF
S - B	2x4 DRY	No.2	SPF
L - J	2x4 DRY	No.2	SPF
S - Q	2x4 DRY	No.2	SPF
Q - N	2x4 DRY	No.2	SPF
N - L	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
EXCEPT			
S - C	2x4 DRY	No.2	SPF
I - L	2x4 DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0
C	TMVW-t	MT20	5.0	8.0
D	TS-t	MT20	3.0	8.0
E	TMVW-t	MT20	5.0	8.0
F	TTWV+p	MT20	4.0	8.0
G	TMVW-t	MT20	5.0	8.0
H	TS-t	MT20	3.0	8.0
I	TMVW-t	MT20	5.0	8.0
J	TMV+p	MT20	3.0	4.0
L	BMVW-t	MT20	4.0	9.0
M, O, P, R				
M	BMVW-t	MT20	4.0	8.0
N	BS-t	MT20	3.0	8.0
Q	BS-t	MT20	3.0	8.0
S	BMVW-t	MT20	4.0	9.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG	IN-SX	IN-SX	BRG	BRG
S	2063	0	2063	0	0	5-8	5-8	5-8	5-8
L	2063	0	2063	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST LCASE		MAX/MIN COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
S	1457	989 / 0	0 / 0	0 / 0	0 / 0
L	1457	989 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-S, L-L

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LCI	MAX	UNBRAC	MEMB.	FORCE (LBS)	MAX	CSI (LC)
FR-TO		FROM	TO	LENGTH	FR-TO				
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	F-O	0 / 866	0.19 (1)	
B-C	0 / 22	-91.8	-91.8	0.40 (1)	10.00	O-G	-728 / 0	0.72 (1)	
C-D	-2808 / 0	-91.8	-91.8	0.48 (1)	3.75	G-M	0 / 391	0.09 (1)	
D-E	-2808 / 0	-91.8	-91.8	0.48 (1)	3.75	M-I	-192 / 18	0.05 (1)	
E-F	-2322 / 0	-91.8	-91.8	0.48 (1)	4.07	P-F	0 / 866	0.19 (1)	
F-G	-2322 / 0	-91.8	-91.8	0.48 (1)	4.07	E-P	-728 / 0	0.72 (1)	
G-H	-2808 / 0	-91.8	-91.8	0.48 (1)	3.75	R-E	0 / 391	0.09 (1)	
H-I	-2808 / 0	-91.8	-91.8	0.48 (1)	3.75	C-R	-192 / 18	0.05 (1)	
I-J	0 / 22	-91.8	-91.8	0.40 (1)	10.00	S-C	-3064 / 0	0.72 (1)	
J-K	0 / 28	-91.8	-91.8	0.12 (1)	10.00	I-L	-3064 / 0	0.72 (1)	
S-B	-344 / 0	0.0	0.0	0.03 (1)	7.81				
L-J	-344 / 0	0.0	0.0	0.03 (1)	7.81				
S-R	0 / 2574	-18.5	-18.5	0.53 (1)	10.00				
R-Q	0 / 2291	-18.5	-18.5	0.47 (1)	10.00				
Q-P	0 / 2291	-18.5	-18.5	0.47 (1)	10.00				
P-O	0 / 1762	-18.5	-18.5	0.38 (1)	10.00				
O-N	0 / 2291	-18.5	-18.5	0.47 (1)	10.00				
N-M	0 / 2291	-18.5	-18.5	0.47 (1)	10.00				
M-L	0 / 2574	-18.5	-18.5	0.53 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 089-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/999 (0.14")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/999 (0.28")

CSI: TC=0.48/1.00 (C-E:1), BC=0.53/1.00 (L-M:1), WB=0.72/1.00 (E-P:1), SS=0.22/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (C) (INPUT = 0.90)
JSI METAL = 0.77 (I) (INPUT = 1.00)

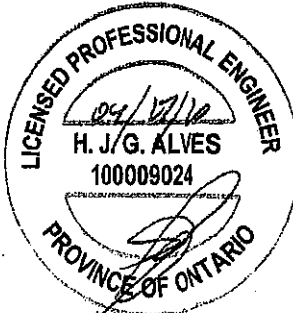

Structural component only
DWG# T-2007114

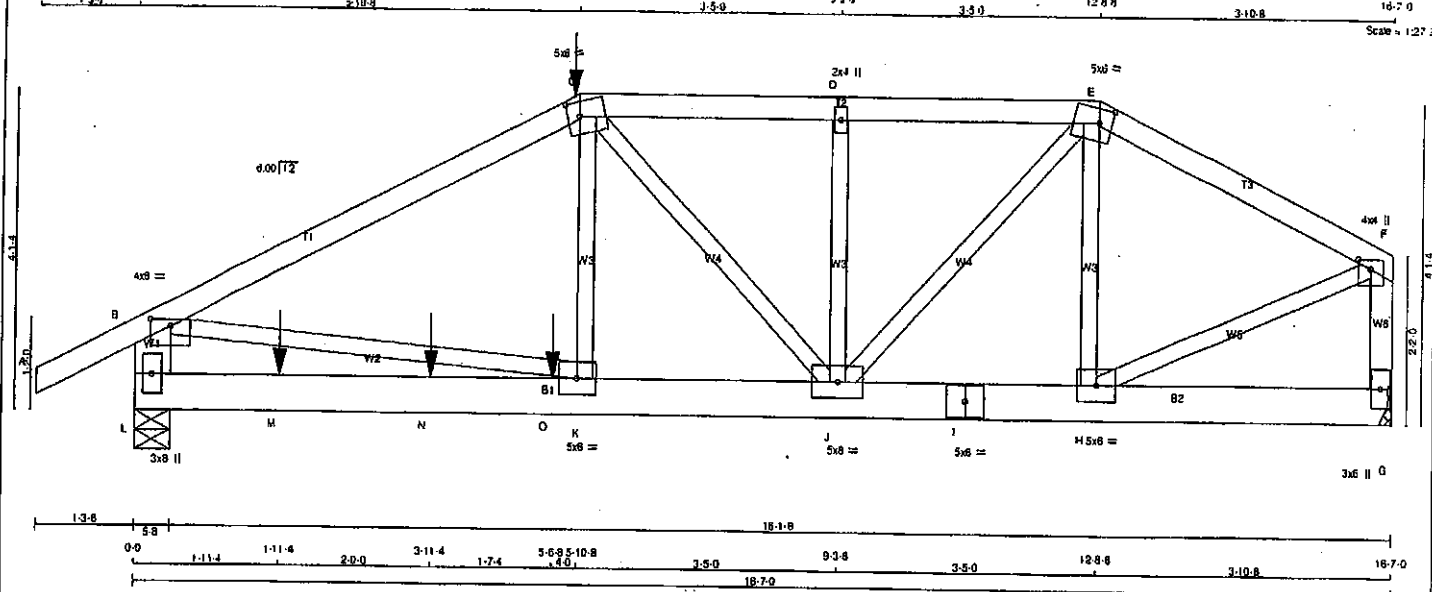

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
L - B	2x6	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
L - I	2x6	DRY	No.2	SPF
I - G	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.
DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A - C	12	SIDE(81.0)
C - E	12	SIDE(81.0)
E - F	12	TOP
G - F	12	TOP
L - B	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
L - I	12	SIDE(0.0)
I - G	12	TOP
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.
GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.
TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.
SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG
								IN-SX	IN-SX
L	2005	0		2005	0	0		5-8	5-8
G	1397	0		1397	0	0		MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 2-0.

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS
JT COMBINED	
L	1412 958 / 0 0 / 0 0 / 0 0 457 / 0 0 / 0
G	985 682 / 0 0 / 0 0 / 0 0 323 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L
BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.18 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 28	-91.8 -91.8 0.07 (1)	10.00	K-C	0 / 943	0.12 (1)	
B-C	-2643 / 0	-91.8 -91.8 0.37 (1)	5.18	C-J	-848 / 0	0.13 (1)	
C-D	-1951 / 0	-91.8 -91.8 0.10 (1)	6.17	J-D	-371 / 0	0.06 (1)	
D-E	-1951 / 0	-91.8 -91.8 0.10 (1)	6.17	J-E	0 / 1047	0.13 (1)	
E-F	-1405 / 0	-91.8 -91.8 0.14 (1)	6.25	H-E	-448 / 0	0.06 (1)	
L-B	-1885 / 0	0.0 0.0 0.07 (1)	7.81	B-K	0 / 2382	0.29 (1)	
G-F	-1369 / 0	0.0 0.0 0.08 (1)	7.81	H-F	0 / 1375	0.17 (1)	
L-M	0 / 0	-18.5 -18.5 0.10 (1)	10.00				
M-N	0 / 0	-18.5 -18.5 0.10 (1)	10.00				
N-O	0 / 0	-18.5 -18.5 0.10 (1)	10.00				
O-K	0 / 0	-18.5 -18.5 0.10 (1)	10.00				
K-J	0 / 2389	-18.5 -18.5 0.24 (1)	10.00				
J-I	0 / 1243	-18.5 -18.5 0.11 (1)	10.00				
I-H	0 / 1243	-18.5 -18.5 0.11 (1)	10.00				
H-G	0 / 0	-18.5 -18.5 0.02 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-320	-320	---	FRONT	VERT	TOTAL	---	C1
M	1-11-4	-25	-26	---	FRONT	VERT	TOTAL	---	C1
N	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
O	5-8-8	-1076	-1076	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS
1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2016

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/380 (0.55")
CALCULATED VERT. DEFL. (LL) = L/999 (0.03")
ALLOWABLE DEFL. (TL) = L/380 (0.55")
CALCULATED VERT. DEFL. (TL) = L/999 (0.06")

CSI: TC=0.37/1.00 (B-C:1), BC=0.24/1.00 (J-K:1), WB=0.29/1.00 (B-K:1), SS=0.37/1.00 (K-L:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MN	MAX MN	MAX MN
618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.80 (B) (INPUT = 0.90)
JSI METAL= 0.32 (B) (INPUT = 1.00)

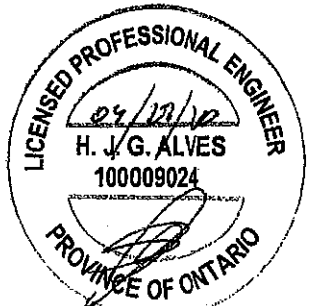

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	T47	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:42 2020 Page 2					
ID17yF?aGQ03cRUI6X1ISrkzWYK-9m42R CCalHJZTIDaWTXzGSyYZD08kZDEYrzNCON					


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	6.0	1.00	3.00
C	TTWW-m	MT20	5.0	6.0	2.25	2.00
D	TMVW-w	MT20	2.0	4.0		
E	TTWW-m	MT20	5.0	6.0	2.25	2.00
F	TMVW-p	MT20	4.0	4.0	1.50	2.00
G	BMV1+p	MT20	3.0	6.0		
H	BMWW-l	MT20	5.0	6.0		
I	BS-l	MT20	5.0	6.0		
J	BMWWW-l	MT20	5.0	6.0		
K	BMWW-l	MT20	5.0	6.0		
L	BMV1+p	MT20	3.0	6.0		

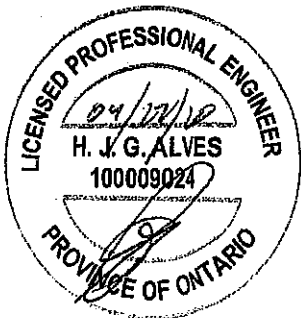

Structural component only
DWG# T-2007115 *ML*

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	T48	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Sat Apr 25 11:28:43 2020 Page 1	

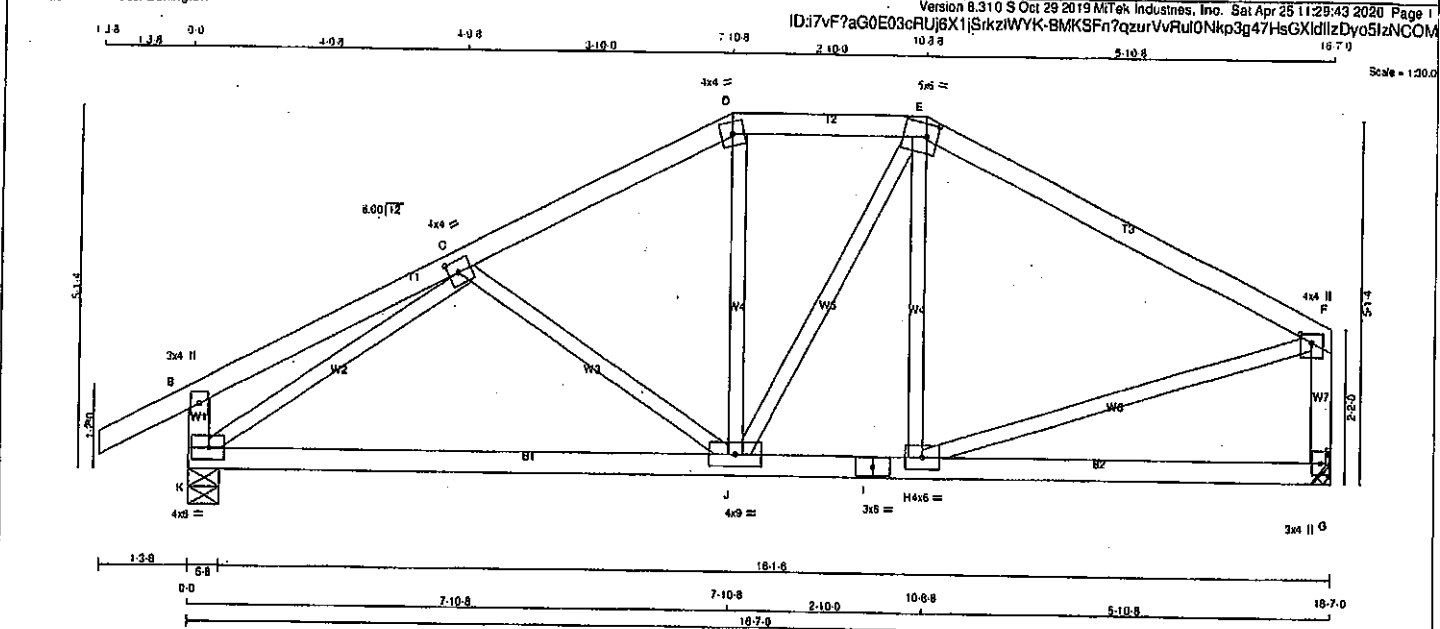

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
K - B	2x4	DRY	No.2
G - F	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - G	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
C	TMWW-I	MT20	4.0	4.0 2.00 1.75
D	TTW-m	MT20	4.0	4.0
E	TTWW-m	MT20	5.0	6.0 2.25 2.00
F	TMVW+p	MT20	4.0	4.0 1.50 2.00
G	BMV1+p	MT20	3.0	4.0
H	BMWW-I	MT20	4.0	6.0
I	BS-I	MT20	3.0	6.0
J	BMWWW-I	MT20	4.0	9.0
K	BMVW1-I	MT20	4.0	6.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER					
BEARINGS					
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	
K	VERT	DOWN	0	0	5-8
G	HORIZ	UPLIFT	0	0	MECHANICAL

UNFACTORED REACTIONS						
JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD
K	732	494 / 0	0 / 0	0 / 0	0 / 0	238 / 0
G	646	424 / 0	0 / 0	0 / 0	0 / 0	222 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K
 BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.12 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
 ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING					
TOTAL LOAD CASES: (4)					
CHORDS					
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORIZ. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS
FR-TO					
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00
B-C	0 / 18	-91.8	-91.8	0.22 (1)	10.00
C-D	-918 / 0	-91.8	-91.8	0.18 (1)	6.24
D-E	-808 / 0	-91.8	-91.8	0.10 (1)	6.25
E-F	-821 / 0	-91.8	-91.8	0.42 (1)	6.12
K-B	-265 / 0	0.0	0.0	0.03 (1)	7.81
G-F	-868 / 0	0.0	0.0	0.10 (1)	7.81
K-J	0 / 993	-18.5	-18.5	0.32 (4)	10.00
J-I	0 / 731	-18.5	-18.5	0.31 (4)	10.00
I-H	0 / 731	-18.5	-18.5	0.31 (4)	10.00
H-G	0 / 0	-18.5	-18.5	0.15 (4)	10.00

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF
SPACING	= 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12
 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014
 (55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.55")
 CALCULATED VERT. DEFL.(LL) = 1/999 (0.02")
 ALLOWABLE DEFL.(TL) = L/360 (0.55")
 CALCULATED VERT. DEFL.(TL) = 1/999 (0.13")
 CSI: TC=0.42/1.00 (E-F:1), BC=0.32/1.00 (J-K:4), WB=0.47/1.00 (C-K:1), SS=0.19/1.00 (E-F:1)
 DOL LUMBER=1.00 (NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10)
 COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1687 788 1987 1656
 PLATE PLACEMENT TOL. = 0.250 inches
 PLATE ROTATION TOL. = 5.0 Deg.
 JSI GRIP = 0.87 (C) (INPUT = 0.90)
 JSI METAL = 0.41 (C) (INPUT = 1.00)




Structural component only
 DWG# T-2007116

Structural component only
DWG# T-2007117

JOB NAME 408152	TRUSS NAME T50	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	ORWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:45 2020 Page 1
ID: i7vF7aG0E03cRUj6X1jSkzWYK-7kSCgT05VV5D8I288onH859SRg_CmbYaRXRu9AZnCOk

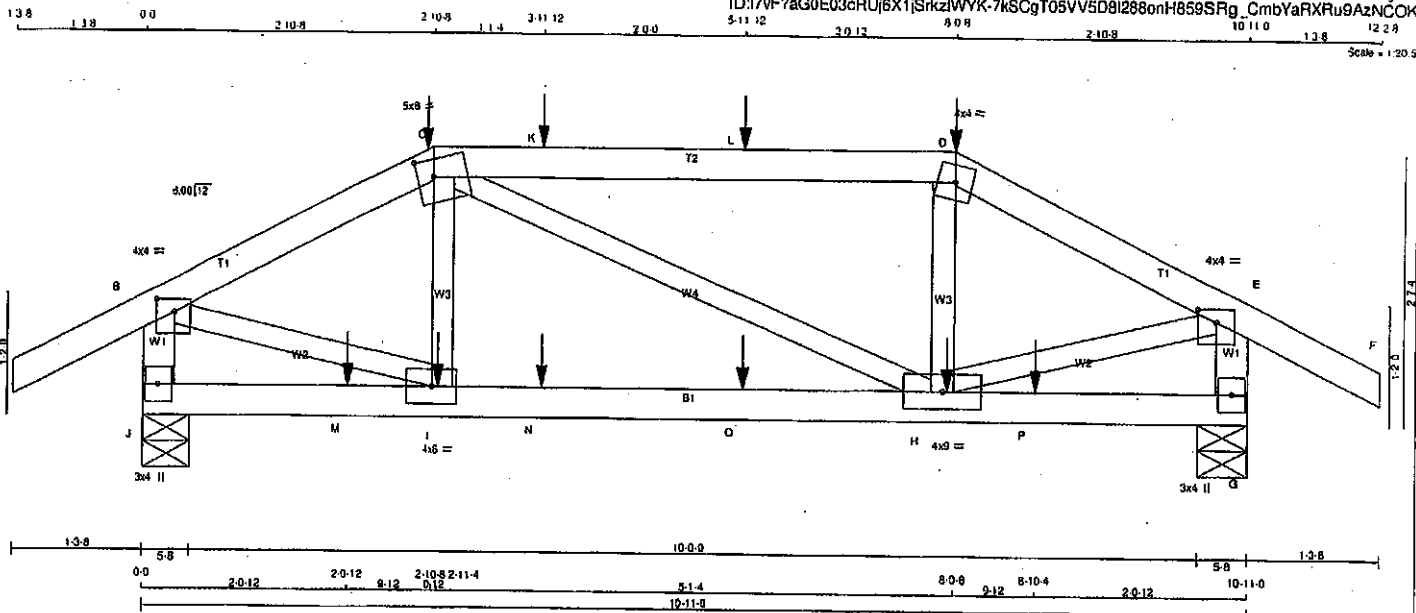

TOTAL WEIGHT = 43 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
J - B	2x4	DRY	No.2
G - E	2x4	DRY	No.2
J - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	4.0	1.50	2.00
C	TTWW-m	MT20	5.0	8.0	2.00	2.00
D	TTW-m	MT20	4.0	4.0		
E	TMVW-p	MT20	4.0	4.0	1.50	2.00
G	BMV1+p	MT20	3.0	4.0		
H	BMVWW-t	MT20	4.0	9.0		
I	BMVWW-l	MT20	4.0	8.0		
J	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	UP	IN-SX
J	868	0	868	0
G	866	0	866	0

UNFACTORED REACTIONS

1ST LCASE	MAX./MIN. COMPONENT REACTIONS
JT	COMBINED
J	611
G	610

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, G

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.09 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (LBS)	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO				FR-TO			
A-B	0/28	-91.8	-91.8	0.13 (1)	10.00	I-C	-121/32
B-C	-837/0	-91.8	-91.8	0.15 (1)	8.25	C-H	0/2
C-K	-743/0	-91.8	-91.8	0.50 (1)	8.09	H-D	-118/34
K-L	-743/0	-91.8	-91.8	0.50 (1)	8.09	B-I	0/778
L-D	-743/0	-91.8	-91.8	0.50 (1)	8.09	H-E	0/783
D-E	-844/0	-91.8	-91.8	0.15 (1)	8.25		
E-F	0/28	-91.8	-91.8	0.13 (1)	10.00		
J-B	-848/0	0.0	0.0	0.09 (1)	7.81		
G-E	-844/0	0.0	0.0	0.09 (1)	7.81		
J-M	0/0	-18.5	-18.5	0.08 (4)	10.00		
M-I	0/0	-18.5	-18.5	0.08 (4)	10.00		
I-N	0/742	-18.5	-18.5	0.18 (1)	10.00		
N-O	0/742	-18.5	-18.5	0.18 (1)	10.00		
O-H	0/742	-18.5	-18.5	0.18 (1)	10.00		
H-P	0/0	-18.5	-18.5	0.08 (4)	10.00		
P-G	0/0	-18.5	-18.5	0.08 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	2-10-8	-119	-119	---	FRONT	VERT	TOTAL	---	C1
D	8-0-8	-119	-119	---	FRONT	VERT	TOTAL	---	C1
H	7-11-12	-5	-5	---	FRONT	VERT	TOTAL	---	C1
I	2-11-4	-5	-5	---	FRONT	VERT	TOTAL	---	C1
K	3-11-12	-7	-7	---	FRONT	VERT	TOTAL	---	C1
L	5-11-12	-7	-7	---	FRONT	VERT	TOTAL	---	C1
M	2-0-12	-5	-5	---	FRONT	VERT	TOTAL	---	C1
N	3-11-12	-5	-5	---	FRONT	VERT	TOTAL	---	C1
O	5-11-12	-5	-5	---	FRONT	VERT	TOTAL	---	C1
P	8-10-4	-5	-5	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.0/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.36")
CALCULATED VERT. DEFL.(LL) = $U/999$ (0.01")
ALLOWABLE DEFL.(TL) = $L/360$ (0.36")
CALCULATED VERT. DEFL.(TL) = $U/999$ (0.03")

CSI: TC=0.50/1.00 (C-D:1), BC=0.18/1.00 (H-I:1), WB=0.19/1.00 (E-H:1), SSI=0.21/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1667	788	1987

PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.77 (E) (INPUT = 0.80)
JSI METAL= 0.28 (E) (INPUT = 1.00)



Structural component only
DWG# T-2007118

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	T51	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 11:29:46 2020 Page 1	

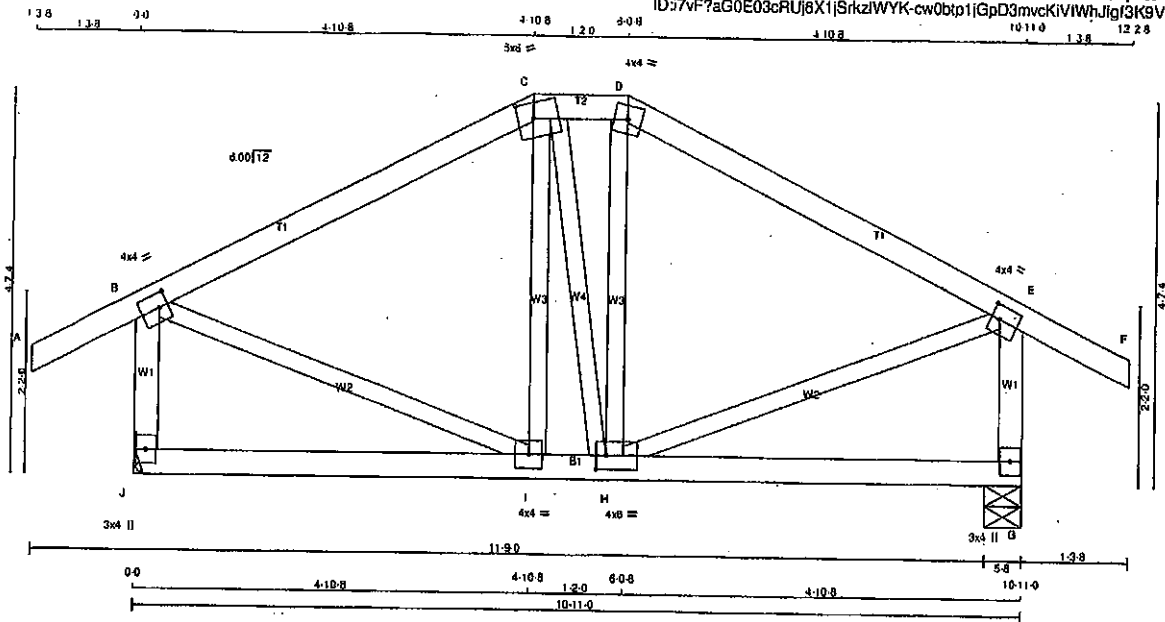

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2		
C - D	2x4	DRY	No.2		
D - F	2x4	DRY	No.2		
J - B	2x4	DRY	No.2		
G - E	2x4	DRY	No.2		
J - G	2x4	DRY	No.2		

ALL WEBS 2x8 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMWW-t	MT20	4.0	4.0	2.00	1.25
C TTWW-m	MT20	5.0	6.0	2.25	2.25
D TTWW-m	MT20	4.0	4.0		
E TMWW-t	MT20	4.0	4.0	2.00	1.25
G BMV-t+p	MT20	3.0	4.0		
H BMWW-t	MT20	4.0	6.0	2.00	1.50
I BMWW-t	MT20	4.0	4.0		
J BMV-t+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORIZ	UPLIFT
J	726	0	0	0
G	726	0	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	511	349/0	0/0	0/0	0/0	0/0	183/0	0/0
G	511	349/0	0/0	0/0	0/0	0/0	183/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)	MAX. FACTORED TORSION (LBS-FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED TORSION (LBS-FT)
FR-TO	0/28	-91.8	-91.8	0.12 (1)	10.00	I-C	-78/18
A-B	0/28	-91.8	-91.8	0.28 (1)	8.25	C-H	-4/0
B-C	-435/0	-91.8	-91.8	0.02 (1)	8.25	H-D	-82/19
C-D	-388/0	-91.8	-91.8	0.28 (1)	8.25	B-I	0/415
D-E	-434/0	-91.8	-91.8	0.12 (1)	10.00	H-E	0/414
E-F	0/28	-91.8	-91.8	0.08 (1)	7.81		
J-B	-688/0	0.0	0.0	0.08 (1)	7.81		
G-E	-688/0	0.0	0.0	0.08 (1)	7.81		
J-I	0/0	-18.5	-18.5	0.10 (4)	10.00		
I-H	0/387	-18.5	-18.5	0.14 (4)	10.00		
H-G	0/0	-18.5	-18.5	0.10 (4)	10.00		

TOTAL WEIGHT = 52 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.36")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.36")
CALCULATED VERT. DEFL. (TL) = L/999 (0.02")

CSI: TC=0.28/1.00 (B-C:1), BC=0.14/1.00 (H-I:4), WB=0.08/1.00 (B-I:1), SS=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1687
	788	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.66 (B) (INPUT = 0.90)
JSI METAL= 0.22 (B) (INPUT = 1.00)

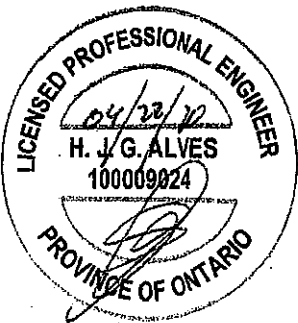

Structural component only
DWG# T-2007119


Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:47 2020 Page 1
ID:7vF?ag0E03cRUj6X1j\$RkzlWYK-47az592L17LwO3BXFDpIDWEm8TgSEVLturw?E3zNCO



Structural component only
DWG# T-2007120

JOB NAME 408152	TRUSS NAME G52	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 11:29:28 2020 Page 1
ID:7vF?aG0E03cRUj8X1iSrkzIWK-7Twn8fpQVHydc8EieizlyWyePpDihyU4WOpV3IzNCOB

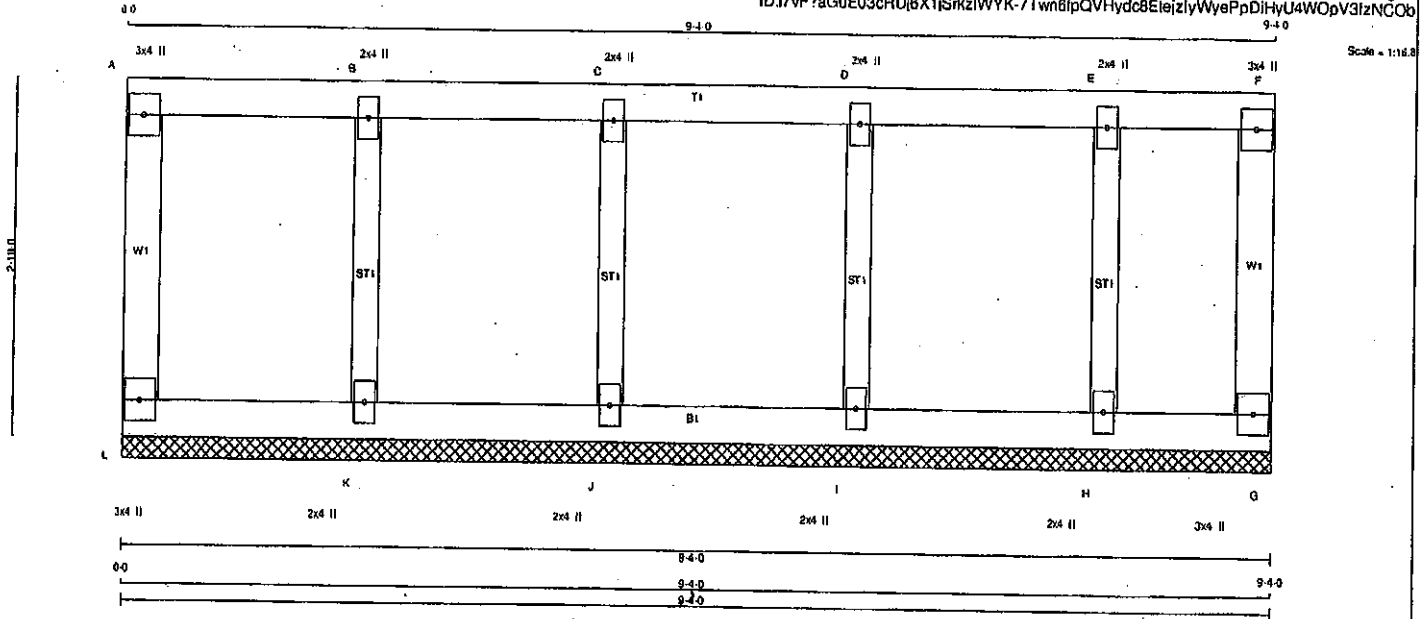

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
L - A	2x4	DRY	No.2
A - F	2x4	DRY	No.2
G - F	2x4	DRY	No.2
L - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2'-0" O.C.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	YMW+p	MT20	3.0	4.0		
B, C, D, E						
B	TMW+w	MT20	2.0	4.0		
F	YMW+p	MT20	3.0	4.0		
G	BMV1+p	MT20	3.0	4.0		
H, I, J, K						
H	BMW1+w	MT20	2.0	4.0		
L	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH FR-TO	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO		FR-TO			
L-A	-101/0	0.0	0.0 0.03 (1)	7.81	K-B	-245/0	0.08 (1)
A-B	-8/0	-114.3	-114.3 0.08 (1)	10.00	J-C	-224/0	0.05 (1)
B-C	-8/0	-114.3	-114.3 0.08 (1)	10.00	I-D	-237/0	0.05 (1)
C-D	-8/0	-114.3	-114.3 0.07 (1)	10.00	H-E	-198/0	0.04 (1)
D-E	-8/0	-114.3	-114.3 0.07 (1)	10.00			
E-F	-8/0	-114.3	-114.3 0.05 (1)	10.00			
G-F	-84/0	0.0	0.0 0.02 (1)	7.81			
L-K	0/8	-18.5	-18.5 0.02 (4)	10.00			
K-J	0/8	-18.5	-18.5 0.02 (4)	10.00			
J-I	0/8	-18.5	-18.5 0.02 (4)	10.00			
I-H	0/8	-18.5	-18.5 0.02 (4)	10.00			
H-G	0/8	-18.5	-18.5 0.02 (1)	10.00			

TOTAL WEIGHT = 34 lb (M/P)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
DL	=	15.0	PSF	
BOT CH.	LL	=	0.0	PSF
DL	=	7.4	PSF	
TOTAL LOAD	=	48.0	PSF	

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.08/1.00 (A-B:1), BG=0.02/1.00 (K-L:4), WB=0.08/1.00 (B-K:1), SS=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.17 (K) (INPUT = 0.90)
JSI METAL = 0.07 (K) (INPUT = 1.00)




Structural component only
DWG# T-2007104

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	T53	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 11:28:18 2020 Page 1
ID:17vF?aG0E03cRUj6X1jSkzWYK-YJ7LIV3zoQTn?DmipwK_mkn0tt?2zwn17VgZmVzNCOH

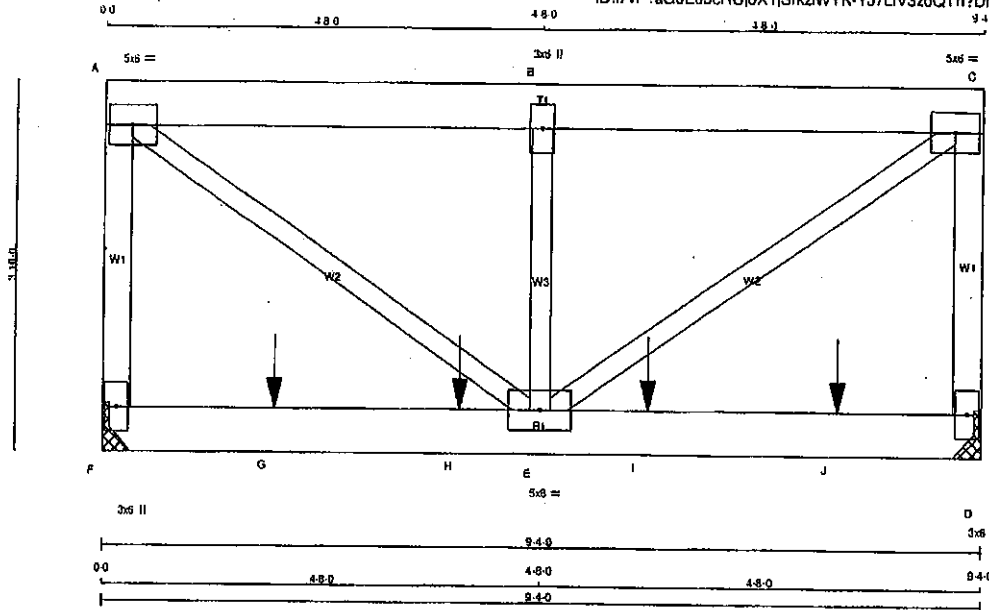

Scale = 1:220

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
F - A	2x4	DRY	No.2	SPF		
A - C	2x6	DRY	No.2	SPF		
D - C	2x4	DRY	No.2	SPF		
F - D	2x6	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
DRY: SEASONED LUMBER.						

PLATES (tablets in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	5.0	8.0		
B	TMVW-1	MT20	3.0	6.0		
C	TMVW-1	MT20	5.0	8.0		
D	BMV1-p	MT20	3.0	8.0		
E	BMVW-1	MT20	5.0	8.0		
F	BMV1-p	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
F	988	0	988	0
D	1012	0	1012	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F, D. MINIMUM BEARING LENGTH AT JOINT F = 3-8, JOINT D = 3-8.

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	705	427/0	0/0	0/0	0/0	279/0	0/0
D	722	439/0	0/0	0/0	0/0	283/0	0/0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LC1 (LC)	MAX. UNBRAC CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)		
FR-TO		FROM	TO		FR-TO				
F-A	-846/0	0.0	0.0	0.23 (1)	7.45	A-E	0/1072 0.35 (1)		
A-B	-889/0	-114.3	-114.3	0.24 (1)	6.25	E-B	-832/0 0.18 (1)		
B-C	-889/0	-114.3	-114.3	0.24 (1)	6.25	E-C	0/1072 0.35 (1)		
D-C	-846/0	0.0	0.0	0.23 (1)	7.45				
F-G	0/0	-18.5	-18.5	0.24 (1)	10.00				
G-H	0/0	-18.5	-18.5	0.24 (1)	10.00				
H-E	0/0	-18.5	-18.5	0.24 (1)	10.00				
E-I	0/0	-18.5	-18.5	0.24 (1)	10.00				
I-J	0/0	-18.5	-18.5	0.24 (1)	10.00				
J-D	0/0	-18.5	-18.5	0.24 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	1-9-12	-180	-180	---	FRONT	VERT	TOTAL	---	C1
H	3-8-12	-190	-190	---	FRONT	VERT	TOTAL	---	C1
I	5-8-12	-190	-190	---	FRONT	VERT	TOTAL	---	C1
J	7-8-12	-190	-190	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
OL = 15.0 PSF
BOT CH. LL = 0.0 PSF
OL = 7.4 PSF
TOTAL LOAD = 48.0 PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIQ 2011, TPIQ 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.31")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.31")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CS1: TC=0.24/1.00 (B-C:1), BC=0.24/1.00 (D-E:1), WB=0.35/1.00 (A-E:1), SS1=0.29/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 616 354 1887 788 1887 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.76 (E) (INPUT = 0.90)
JSI METAL = 0.32 (E) (INPUT = 1.00)

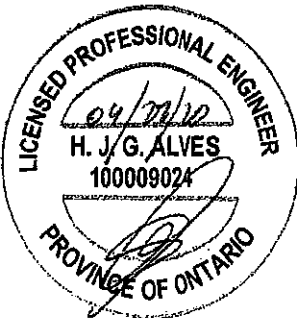


Structural component only
DWG# T-2007121

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408152	IT54	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:50 2020 Page 1
ID:7vF7aG0E03cRUj6X1jSrkziWYK-UIF5jA4DJ2jVFWw6xLMSR9sN4hadRnVJap9frOzNCOF

Scale = 1/32"

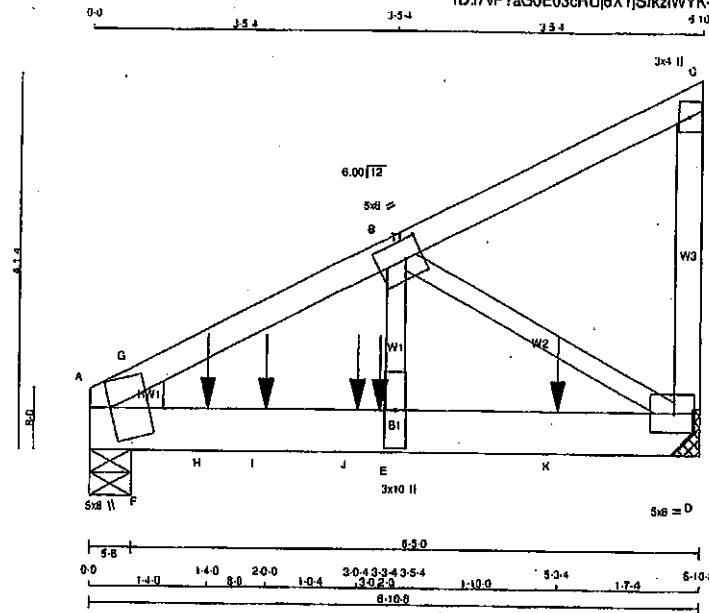

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF		
D - C	2x4 DRY	No.2	SPF		
A - D	2x6 DRY	No.2	SPF		
ALL WEBS	2x3 DRY	No.2	SPF		
	DRY: SEASONED LUMBER.				

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 1 12	TOP	
C - D 1 12	TOP	
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
A - D 2 12	SIDE (0.0)	
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1 8		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A - TBMH1+m	MT20	5.0	8.0	3.50	
B - TBMWV-1	MT20	5.0	8.0	2.50	2.25
C - TBMV+p	MT20	3.0	4.0		
D - BMVW1-1	MT20	5.0	8.0	2.50	2.75
E - BMVWw	MT20	3.0	10.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	HEEL WEDGE
JT	VERT	HORZ	UPLIFT	IN-SX	
A	3467	0	3467	0	5-8
D	2454	0	2454	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
A	2449	1822 / 0	0 / 0	0 / 0	0 / 0	828 / 0
D	1735	1144 / 0	0 / 0	0 / 0	0 / 0	591 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.18 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED CSI (LC)	MAX. UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO					FR-TO		
A-G	-4978 / 0	-91.8	-91.8 0.19 (1)	4.16	E-B	0 / 3385	0.42 (1)
G-B	-3863 / 0	-91.8	-91.8 0.17 (1)	4.66	B-D	-4035 / 0	0.53 (1)
B-C	-13 / 0	-91.8	-91.8 0.07 (1)	6.25	F-G	0 / 1740	0.00 (1)
D-C	-129 / 0	0.0	0.0 0.02 (1)	7.81			
A-F	0 / 3490	-18.5	-18.5 0.25 (1)	10.00			
F-H	0 / 3490	-18.5	-18.5 0.68 (1)	10.00			
H-I	0 / 3490	-18.5	-18.5 0.68 (1)	10.00			
I-J	0 / 3490	-18.5	-18.5 0.68 (1)	10.00			
J-E	0 / 3490	-18.5	-18.5 0.68 (1)	10.00			
E-K	0 / 3490	-18.5	-18.5 0.49 (1)	10.00			
K-D	0 / 3490	-18.5	-18.5 0.49 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
H	1-4-0	-1378	-1378	---	BACK	VERT	TOTAL	---	C1
I	2-0-0	-1000	-1000	---	FRONT	VERT	TOTAL	---	C1
J	3-0-4	-994	-994	---	FRONT	VERT	TOTAL	---	C1
J	3-3-4	-898	-898	---	BACK	VERT	TOTAL	---	C1
K	5-3-4	-898	-898	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 30 = 60 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL = 25.8	PSF
DL = 6.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.4	PSF	
TOTAL LOAD = 39.0	PSF	

SPACING = 24.0 IN. C/C

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIG 2011, TPIG 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.23")
CALCULATED VERT. DEFL. (LL) = L/999 (0.03")
ALLOWABLE DEFL. (TL) = L/360 (0.23")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CSI: TC=0.18/1.00 (A-G:1), BC=0.68/1.00 (E-F:1),
WB=0.53/1.00 (B-D:1), SB=0.80/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (B) (INPUT = 0.90)
JSI METAL = 0.70 (A) (INPUT = 1.00)

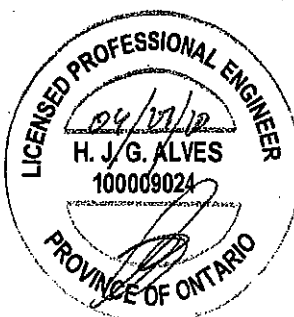


Structural component only
DWG# T-2007122

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408150	G60	4	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 11:02:39 2020 Page 1
ID:7VF7aG0E03cHJ6X1jSrkzWYK-kwCWPUL9QwEw4kEulc..ECpgnD4MnCBFXZZ4QzNCnk

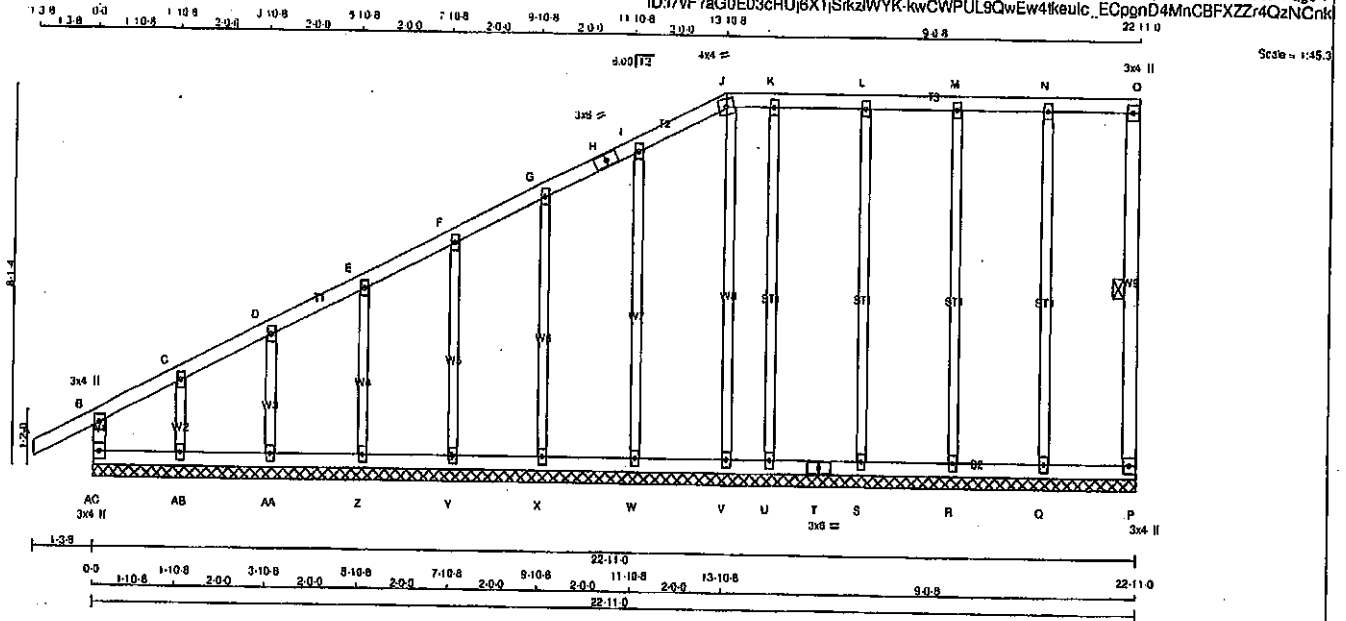

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
AC - B	2x4 DRY	No.2	SPF		
A - H	2x4 DRY	No.2	SPF		
H - J	2x4 DRY	No.2	SPF		
J - O	2x4 DRY	No.2	SPF		
P - O	2x4 DRY	No.2	SPF		
AC - T	2x4 DRY	No.2	SPF		
T - P	2x4 DRY	No.2	SPF		
ALL WEBS	2x3 DRY	No.2	SPF		
ALL GABLE WEBS	2x3 DRY	No.2	SPF		
DRY: SEASONED LUMBER.					
GABLE STUDS SPACED AT	2'-0\"	OC.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF O-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING				TOTAL LOAD CASES: (4)			
CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)	
FR-TO		FROM TO		FR-TO			
AC-B	-224/0	0.0	0.0 0.02 (1)	Q-N	-195/0	0.25 (1)	
A-B	0/28	-91.8	-91.8 0.12 (1)	R-M	-183/0	0.23 (1)	
B-C	-26/0	-91.8	-91.8 0.04 (1)	S-L	-188/0	0.24 (1)	
C-D	-19/0	-91.8	-91.8 0.04 (1)	U-K	-136/0	0.17 (1)	
D-E	-15/0	-91.8	-91.8 0.04 (1)	V-J	-131/0	0.17 (1)	
E-F	-11/0	-91.8	-91.8 0.04 (1)	W-I	-185/0	0.17 (1)	
F-G	-8/0	-91.8	-91.8 0.04 (1)	X-G	-183/0	0.11 (1)	
G-H	-6/0	-91.8	-91.8 0.04 (1)	Y-F	-182/0	0.07 (1)	
H-I	-6/0	-91.8	-91.8 0.04 (1)	Z-E	-182/0	0.05 (1)	
I-J	-6/0	-91.8	-91.8 0.04 (1)	AA-D	-183/0	0.03 (1)	
J-K	-2/0	-91.8	-91.8 0.03 (1)	AB-C	-178/0	0.03 (1)	
K-L	-2/0	-91.8	-91.8 0.04 (1)				
L-M	-2/0	-91.8	-91.8 0.04 (1)				
M-N	-2/0	-91.8	-91.8 0.04 (1)				
N-O	-2/0	-91.8	-91.8 0.04 (1)				
P-O	-61/0	0.0	0.0 0.01 (1)				
AC-AB	0/24	-18.5	-18.5 0.02 (4)				
AB-AA	0/17	-18.5	-18.5 0.02 (4)				
AA-Z	0/13	-18.5	-18.5 0.02 (4)				
Z-Y	0/10	-18.5	-18.5 0.02 (4)				
Y-X	0/7	-18.5	-18.5 0.01 (4)				
X-W	0/5	-18.5	-18.5 0.02 (4)				
W-V	0/4	-18.5	-18.5 0.02 (4)				
V-U	0/2	-18.5	-18.5 0.01 (4)				
U-T	0/2	-18.5	-18.5 0.02 (4)				
T-S	0/2	-18.5	-18.5 0.02 (4)				
S-R	0/2	-18.5	-18.5 0.02 (4)				
R-Q	0/2	-18.5	-18.5 0.02 (4)				
Q-P	0/2	-18.5	-18.5 0.02 (4)				

TOTAL WEIGHT = 4 X 116 = 464 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2010, OBC 2012, ABC 2010
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (Q-R:4), WS=0.25/1.00 (N-Q:1), SS=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1867 798 1887 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.60 (J) (INPUT = 0.90)

JSI METAL= 0.08 (I) (INPUT = 1.00)




Structural component only
DWG# T-2007057

JOB NAME 408150	TRUSS NAME GP1	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 11:02:40 2020 Page 1

ID:7vF7aG0E03cRUj6X1jSrkzWYK-C6mudqMnBDMnh0JqS07DnQMnclNpWgWomDIPdszNCn

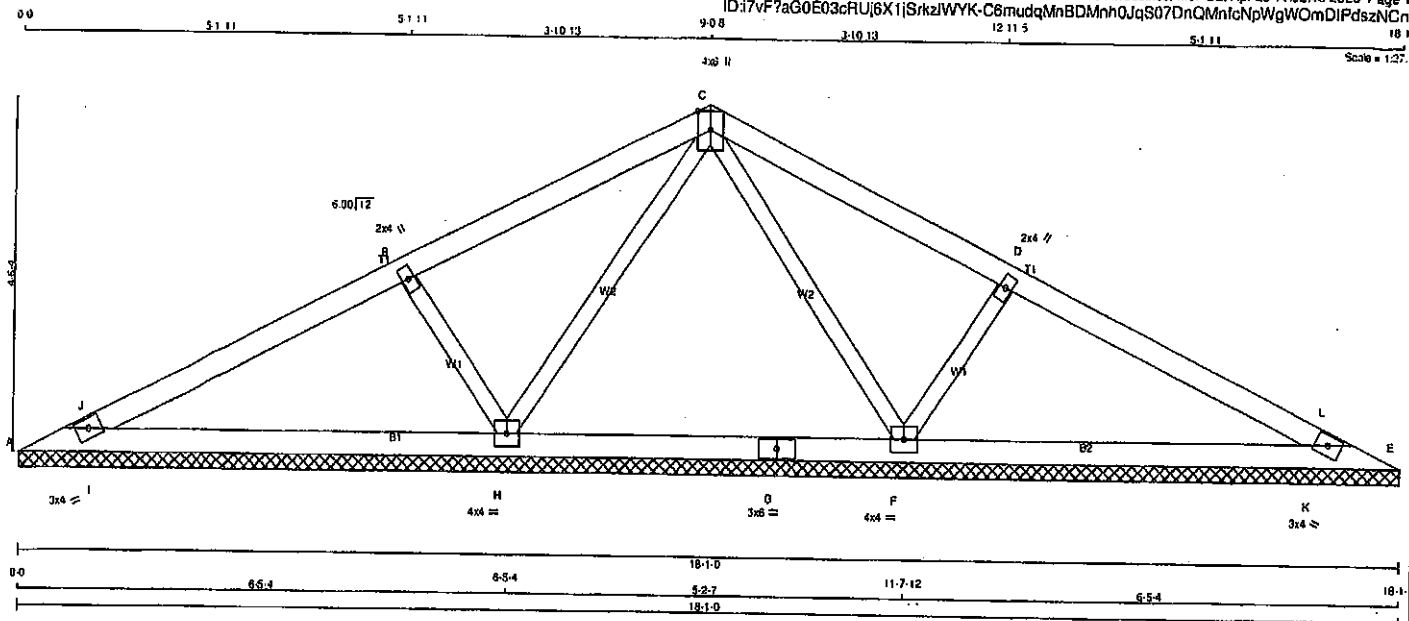

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4 DRY	No.2	SPF
C - E	2x4 DRY	No.2	SPF
A - G	2x4 DRY	No.2	SPF
G - E	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TBM1-h	MT20	3.0	4.0	
B	TMW+w	MT20	2.0	4.0	
C	TTW+w	MT20	4.0	6.0	Edge
D	TMW+w	MT20	2.0	4.0	
E	TBM1-h	MT20	3.0	4.0	
F	BMWW1-t	MT20	4.0	4.0	
G	BS-t	MT20	3.0	6.0	
H	BMWW1-t	MT20	4.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
A	134	0	134	0	18-1-0 (9-11-18)1-0	
E	134	0	134	0	18-1-0 (9-11-18)1-0	
F	863	0	863	0	18-1-0 (9-11-18)1-0	
H	863	0	863	0	18-1-0 (9-11-18)1-0	

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	94	88 / 0	0 / 0	0 / 0	0 / 0	28 / 0	0 / 0
E	94	88 / 0	0 / 0	0 / 0	0 / 0	28 / 0	0 / 0
F	611	395 / 0	0 / 0	0 / 0	0 / 0	218 / 0	0 / 0
H	611	395 / 0	0 / 0	0 / 0	0 / 0	218 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, F, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO		FR-TO			
A-J	0 / 240	-91.8 -91.8	0.12 (1)	10.00	C-F	-428 / 0	0.18 (1)
J-B	0 / 301	-91.8 -91.8	0.34 (1)	10.00	F-D	-435 / 0	0.08 (1)
B-C	0 / 503	-91.8 -91.8	0.37 (1)	10.00	H-C	-428 / 0	0.18 (1)
C-D	0 / 503	-91.8 -91.8	0.37 (1)	10.00	B-H	-438 / 0	0.08 (1)
D-L	0 / 301	-91.8 -91.8	0.34 (1)	10.00	I-J	-78 / 35	0.00 (1)
L-E	0 / 240	-91.8 -91.8	0.12 (1)	10.00	K-L	-78 / 35	0.00 (1)
A-I	-255 / 0	-18.5 -18.5	0.11 (1)	8.25			
I-H	-243 / 0	-18.5 -18.5	0.13 (4)	8.25			
H-G	-246 / 0	-18.5 -18.5	0.13 (4)	8.25			
G-F	-246 / 0	-18.5 -18.5	0.13 (4)	8.25			
F-K	-243 / 0	-18.5 -18.5	0.13 (4)	8.25			
K-E	-255 / 0	-18.5 -18.5	0.11 (1)	8.25			

TOTAL WEIGHT = 2 X 54 = 107 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8 PSF
	DL = 8.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(56 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CS1: TC=0.37/1.00 (C-D:1), BC=0.13/1.00 (F-K:4), WB=0.18/1.00 (C-H:1), SS=0.17/1.00 (D-L:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.48 (H) (INPUT = 0.90)
JSI METAL= 0.15 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007058

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408150	P1	17	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:02:45 2020 Page 1
ID: i7vF?aG0E03cRUj8X1|SrKzIWYK-Z4ZngXQw0m_4ocBoEZJOUT3e9d5nBxS8v0AI4zNCrns

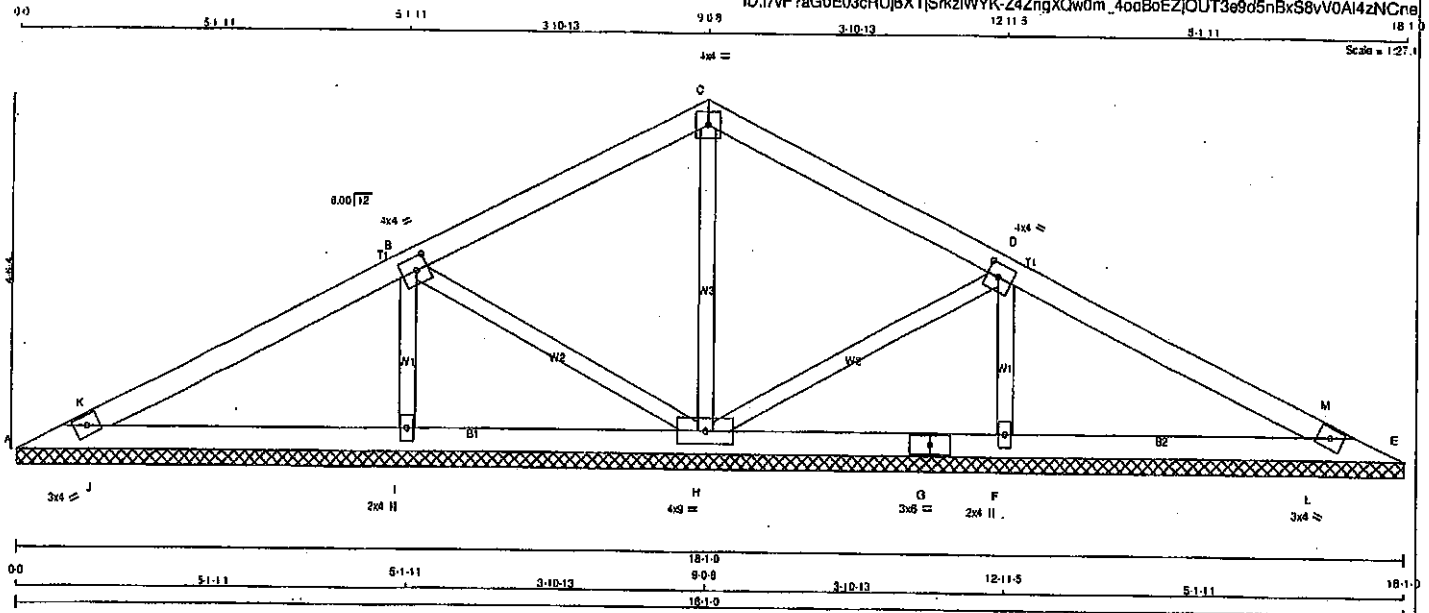

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
A - G	2x4	DRY	No.2
G - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
A	TBM1-h	MT20	3.0	4.0
B	TMWV1	MT20	4.0	4.0
C	TTW-p	MT20	4.0	4.0
D	TMWV1	MT20	4.0	4.0
E	TBM1-h	MT20	3.0	4.0
F	BMW1-w	MT20	2.0	4.0
G	BS-1	MT20	3.0	6.0
H	BMWVW1-1	MT20	4.0	9.0
I	BMW1-w	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX
A	124	0	124	0	18-1-0 (11-11)E1-0		
E	124	0	124	0	18-1-0 (11-11)E1-0		
H	415	0	415	0	18-1-0 (11-11)E1-0		
F	668	0	668	0	18-1-0 (11-11)E1-0		
I	668	0	668	0	18-1-0 (11-11)E1-0		

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	87	59/0	0/0	0/0	0/0	0/0	28/0	0/0
E	87	59/0	0/0	0/0	0/0	0/0	28/0	0/0
H	293	192/0	0/0	0/0	0/0	0/0	101/0	0/0
F	471	307/0	0/0	0/0	0/0	0/0	164/0	0/0
I	471	307/0	0/0	0/0	0/0	0/0	164/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, H, F, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-K	0/248	-91.8 -91.8 0.07 (1)	10.00	H-C	-445/0	0.13 (1)	
K-B	0/292	-91.8 -91.8 0.32 (1)	10.00	H-D	0/59	0.01 (1)	
B-C	0/188	-91.8 -91.8 0.30 (1)	10.00	F-D	-528/0	0.08 (1)	
C-D	0/188	-91.8 -91.8 0.30 (1)	10.00	B-H	0/59	0.01 (1)	
D-M	0/292	-91.8 -91.8 0.32 (1)	10.00	I-B	-528/0	0.08 (1)	
M-E	0/248	-91.8 -91.8 0.07 (1)	10.00	J-K	-128/6	0.00 (1)	
A-J	-256/0	-18.5 -18.5 0.14 (1)	6.25	L-M	-128/6	0.00 (1)	
J-I	-240/0	-18.5 -18.5 0.14 (1)	6.25				
I-H	-240/0	-18.5 -18.5 0.11 (1)	6.25				
H-G	-240/0	-18.5 -18.5 0.11 (1)	6.25				
G-F	-240/0	-18.5 -18.5 0.11 (1)	6.25				
F-L	-240/0	-18.5 -18.5 0.14 (1)	6.25				
L-E	-256/0	-18.5 -18.5 0.14 (1)	6.25				

TOTAL WEIGHT = 17 X 55 = 943 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.32/1.00 (D-M:1), BC=0.14/1.00 (F-L:1), WB=0.13/1.00 (C-H:1), SSI=0.17/1.00 (D-M:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 768 1887 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.51 (8) (INPUT = 0.90)
JSI METAL= 0.13 (C) (INPUT = 1.00)





Structural component only
DWG# T-2007062

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408151	PB20	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:19:42 2020 Page 1
ID:h2dlfgC44wS_E2izqPs_atzIRw-HkWF6HjVE7m4HfJfStCwhPKbCR_v_qmDIUd2NCXI

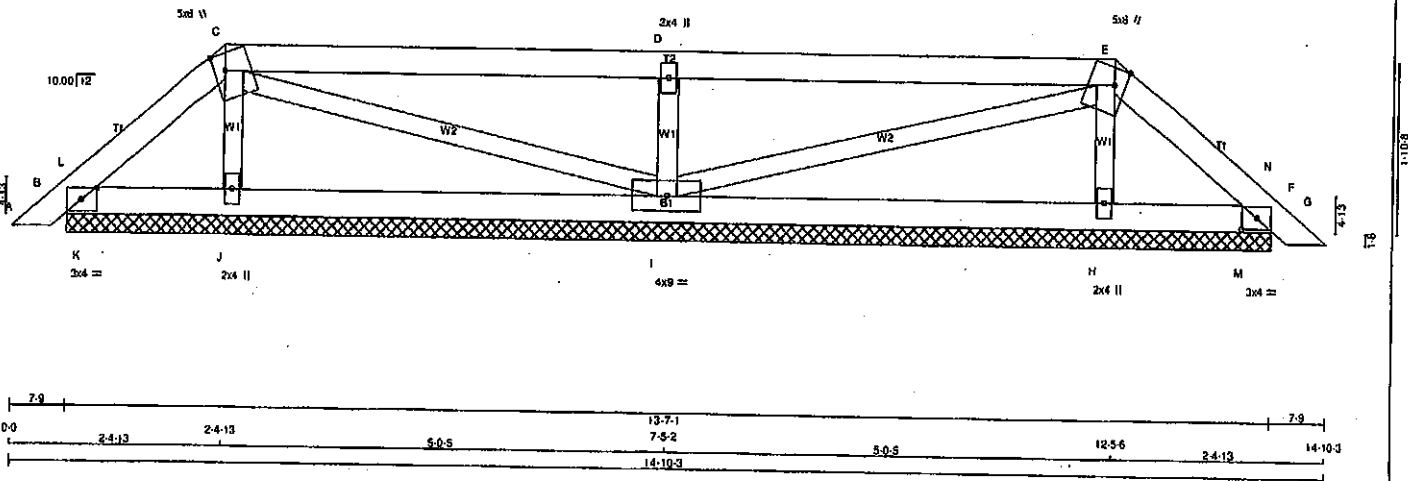

LUMBER				DESCR.	
N. L. G. A. RULES	SIZE	LUMBER		SPF	
CHORDS					
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
E - G	2x4	DRY	No.2	SPF	
G - I	2x4	DRY	No.2	SPF	
I - K	2x4	DRY	No.2	SPF	
K - M	2x4	DRY	No.2	SPF	
M - N	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (Labels in inches)					
JT	TYPE	PLATES	W	LEN	X
B	TM81-I	MT20	3.0	4.0	1.50 2.00
C	TTWW+m	MT20	5.0	6.0	2.25 1.50
D	TMW+w	MT20	2.0	4.0	
E	TTWW+m	MT20	5.0	6.0	2.25 1.50
F	TM81-I	MT20	3.0	4.0	1.50 2.00
H	BMW1+w	MT20	2.0	4.0	
I	BMW1+w	MT20	4.0	9.0	
J	BMW1+w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
B	169	0	169	0	0	13-7-1	13-7-1		
F	169	0	169	0	0	13-7-1	13-7-1		
J	288	0	288	0	0	13-7-1	13-7-1		
I	883	0	883	0	0	13-7-1	13-7-1		
H	288	0	288	0	0	13-7-1	13-7-1		

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	116	93/0	0/0	0/0	0/0	23/0	0/0
F	116	93/0	0/0	0/0	0/0	23/0	0/0
J	207	118/0	0/0	0/0	0/0	89/0	0/0
I	481	327/0	0/0	0/0	0/0	154/0	0/0
H	207	118/0	0/0	0/0	0/0	89/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS (B, F, J, I, H)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FROM	TO	FR-TO	
A-B	0/14	-91.8	-91.8 0.02 (1)	J-C	-194/0
B-L	-31/4	-91.8	-91.8 0.01 (1)	C-I	-22/0
L-C	-60/0	-91.8	-91.8 0.03 (1)	I-E	-578/0
C-D	-8/0	-91.8	-91.8 0.39 (1)	E-G	-22/0
D-E	-8/0	-91.8	-91.8 0.39 (1)	H-E	-194/0
E-N	-80/0	-91.8	-91.8 0.03 (1)	K-L	-121/0
N-F	-31/4	-91.8	-91.8 0.01 (1)	M-N	-121/0
F-G	0/14	-91.8	-91.8 0.02 (1)		
B-K	0/42	-18.5	-18.5 0.04 (1)		
K-J	0/42	-18.5	-18.5 0.07 (4)		
J-I	0/29	-18.5	-18.5 0.10 (4)		
I-H	0/29	-18.5	-18.5 0.10 (4)		
H-M	0/42	-18.5	-18.5 0.07 (4)		
M-F	0/42	-18.5	-18.5 0.04 (1)		

TOTAL WEIGHT = 2 X 45 = 90 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPC 2011, TPC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.39/1.00 (C-D:1), BC=0.10/1.00 (I-J:4), WB=0.02/1.00 (D-I:1), SS=0.22/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	618	354	1687
	788	1587	1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.30 (D) (INPUT = 0.90)
JSI METAL= 0.12 (D) (INPUT = 1.00)




Structural component only
DWG# T-2007080

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408150	U1	21	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 26 11:02:42 2020 Page 1
ID:7vF?aG0E03cRUj8X1jSrkzWYK-9Vif1WN1jrcVxKTDZRHs/R4TQ3I_cmhDXnWhizNCnh

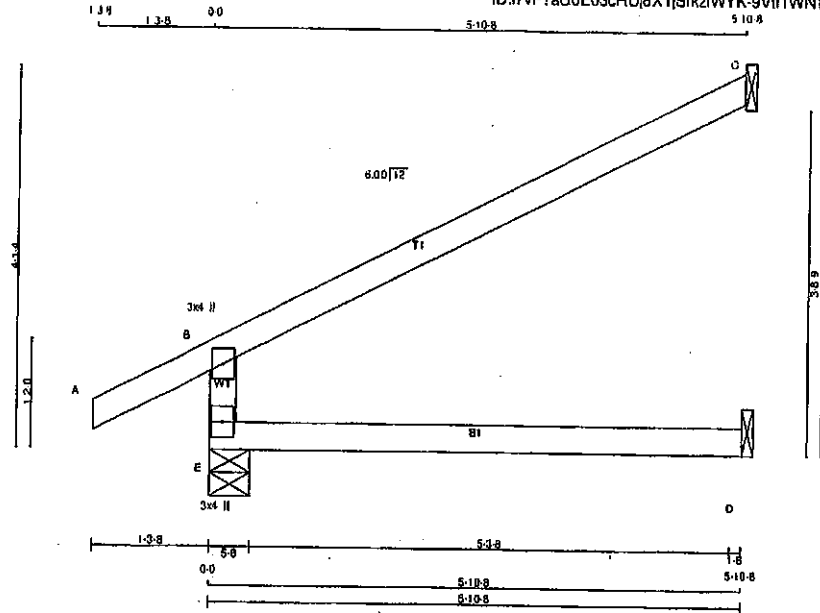

Scale = 1:22.9

CHORDS	SIZE	NUMBER
E - B	2x4 DRY	No.2
A - C	2x4 DRY	No.2
E - D	2x4 DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE	PLATES			
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
	GROSS REACTION	GROSS REACTION	BRG	BRG
	VERT	HORZ	DOWN	HORZ
	UP	DOWN	UP	DOWN
JT	525	0	525	0
E	202	0	202	0
C	45	0	45	0
D	0	50	0	50

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS	1ST CASE	MAX/MIN	COMPONENT REACTIONS
	COMBINED	SNOW	LIVE
	PERM	LIVE	WIND
	DEAD	SOIL	
JT	369	257 / 0	0 / 0
E	139	113 / 0	0 / 0
C	38	0 / 0	0 / 0
D	0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO		FR-TO			
E-B	-461 / 0	0.0	0.0	0.13 (4)			7.81
A-B	0 / 28	-91.8	-91.8	0.12 (1)			10.00
B-C	-30 / 0	-91.8	-91.8	0.54 (1)			6.25
E-D	0 / 0	-18.5	-18.5	0.13 (4)			10.00

TOTAL WEIGHT = 21 X 17 = 353 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.03")

CS1: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SS=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

PLATE	GRIP (DRY)	SHEAR	SECTION
	(PS)	(PL)	(PL)
	MAX	MIN	MAX
MT20	618	354	1667
	788	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.19 (E) (INPUT = 0.90)
JSI METAL = 0.13 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007059

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 26 11:02:43 2020 Page 1
ID:7vF7aG0E03cRUj6X1jSkzlWYK-dhR1F0U0kMYU2P78gwP2_KzqQl30rSBX3DBzNCng



JSI GRIP= 0.24 (B) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)


Tamarack Pool Truss, Burlington



TOTAL WEIGHT = 6 X 12 = 71 lb

DRY: SEASONED LUMBER.

JSI GRIP= 0.24 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408152	J40	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:29 2020 Page 1
ID:17vF7aG0E03cRUj6X1jSkzWYK-bU9J7q2Gb4UDlp3CRUXVjVnrDY50PbEi2Z2b8zNCOs

Scale = 1/23.2

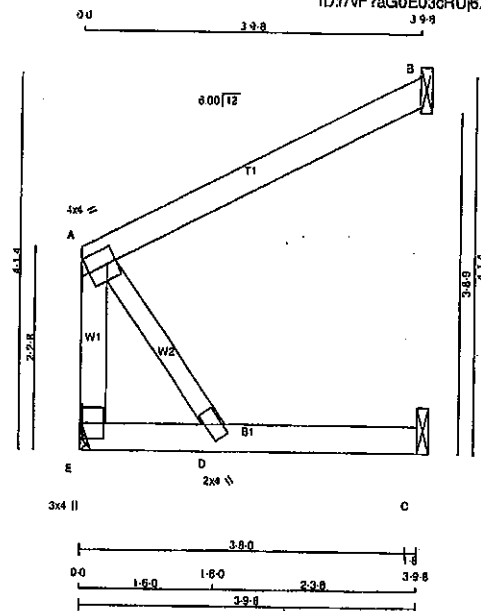

LUMBER				DESCR.	
N. L. G. A. RULES				SPF	
CHORDS	SIZE	LUMBER		SPF	
E - A	2x4	DRY	No.2	SPF	
A - B	2x4	DRY	No.2	SPF	
E - C	2x4	DRY	No.2	SPF	
ALL WEBS 2x3 DRY No.2				SPF	
DRY: SEASONED LUMBER.					

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
A - TMW-1	MT20	4.0	4.0	2.00	1.25
D - BMW-w	MT20	2.0	4.0		
E - BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG
E	209	0	0	209	0	0	0	MECHANICAL	IN-SX
B	174	0	0	174	0	0	1-8	1-8	
C	35	0	0	39	0	0	1-8	1-8	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS		MAX/MIN COMPONENT REACTIONS					
JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	148	97/0	0/0	0/0	0/0	51/0	0/0
B	120	97/0	0/0	0/0	0/0	23/0	0/0
C	28	0/0	0/0	0/0	0/0	28/0	0/0

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING		TOTAL LOAD CASES: (4)							
		CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD	FACTORED (PLF)	LC1 MAX	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED (LC)	
FR-TO		FROM	TO	SI (LC)	7.81	FR-TO			
E-A	-174/0	0.0	0.0	0.02 (1)	10.00	A-D	0/0	0.00 (1)	
A-B	0/0	-91.8	-91.8	0.22 (1)	10.00				
E-D	0/0	-18.5	-18.5	0.07 (4)	10.00				
D-C	0/0	-18.5	-18.5	0.08 (4)	10.00				

TOTAL WEIGHT = 4 X 13 = 52 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.22/1.00 (A-B:1), BC=0.08/1.00 (C-D:4), WB=0.00/1.00 (A-D:1), SS=0.12/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP = 0.11 (A) (INPUT = 0.90)
JSI METAL = 0.03 (A) (INPUT = 1.00)

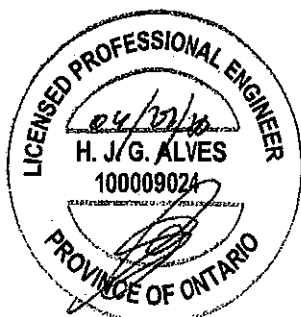

Structural component only
DWG# T-2007105

JOB NAME 408152	TRUSS NAME J41	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:28:31 2020 Page 1
 ID:J7vF?aG0E03cRUj6X1jSrkzWYK-Y2cwkhrrJoCKCTbzSJsX?a8a7q0FFUJ5WDM29g_zNCOY
 Scale = 1/16"

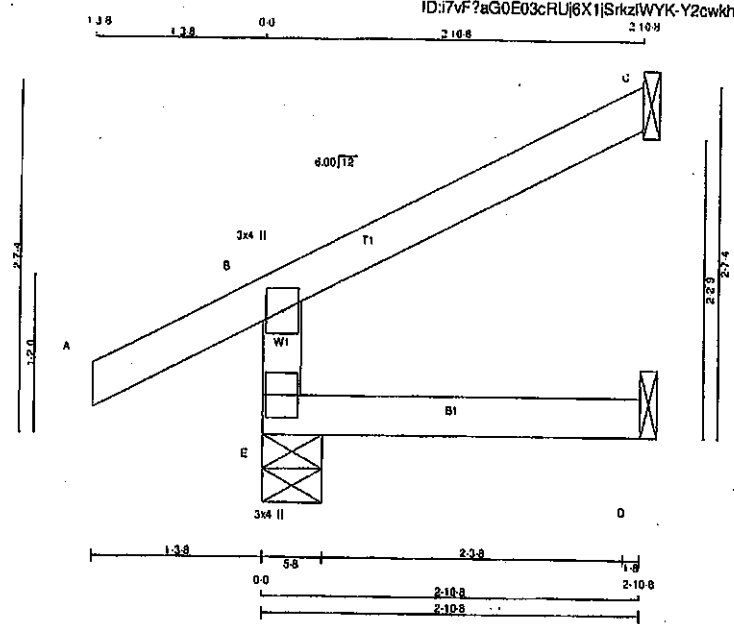

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT 8RG	RECORD 8RG
	VERT	HORZ	DOWN	HORZ		
E	319	0	319	0	5-8	5-8
C	99	0	99	0	1-8	1-8
D	23	0	28	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97781H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX/MIN COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	223	161 / 0	0 / 0	0 / 0	0 / 0	62 / 0	0 / 0
C	68	55 / 0	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0
D	18	0 / 0	0 / 0	0 / 0	0 / 0	18 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS				WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (LC)		MEMB. FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (LC)	MEMB. FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (LC)
			FROM	TO				
FR-TO								
E-B	-269 / 0	0.0	0.0	0.02 (4)	7.81			
A-B	0 / 28	-91.8	-91.8	0.13 (5)	10.00			
B-C	-15 / 0	-91.8	-91.8	0.13 (1)	6.25			
E-D	0 / 0	-18.5	-18.5	0.03 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 4 X 10 = 38 lb

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 OL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 OL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF NBC 2010, NBC 2012, ABC 2019
 - PART 9 OF NBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
 - OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
 CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
 ALLOWABLE DEFL. (TL) = L/360 (0.19")
 CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.13/1.00 (B-C:1), BC=0.03/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
 PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.12 (E) (INPUT = 0.90)
 JSI METAL = 0.08 (B) (INPUT = 1.00)

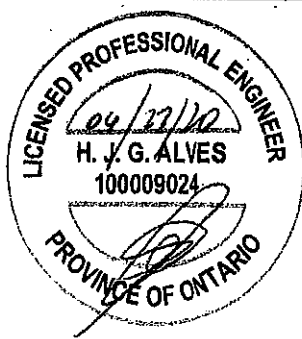


Structural component only
 DWG# T-2007106

Structural component only
DWG# T-2007055

JOB NAME 408150	TRUSS NAME C2	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sal Apr 25 11:02:38 2020 Page 1
ID:7vF7aG0E03cRUj6X1jSrkziWYK-Gke8C8KXfc83Sj9SKb4I7GVwpk52cn6lvpIY_zNCn

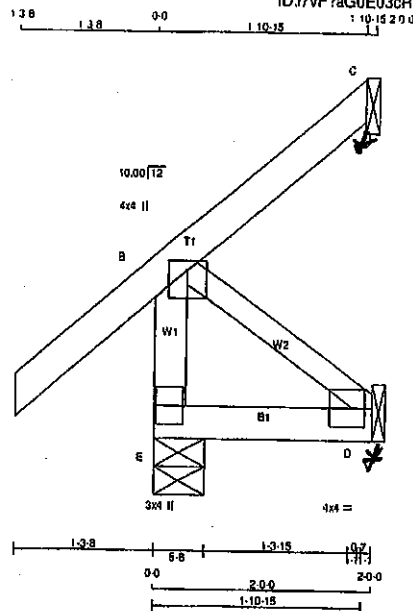

Scale = 1:19.0

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DESCR.
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT		JT		IN-SX		IN-SX	
E	278	0	278	0	5-8	5-8	
C	42	0	42	0	1-8	1-8	
D	18	0	20	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B9791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS		MAX. MIN. COMPONENT REACTIONS	
1ST CASE		SNOW	LIVE
JT		COMBINED	
E	184	145/0	0/0
C	29	23/-26	0/0
D	14	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		WEBS	
MEMB.	FORCE	MEMB.	FORCE
FR-TO		FR-TO	
E-B	-261/0	B-D	0/0
A-B	0/41		
B-C	-29/0		
E-D	0/0		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TO=0.13/1.00 (A-B:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (B-D:1), SS=0.08/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)	(PL)
MT20	818	354	1867

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.20 (B) (INPUT = 0.99)
JSI METAL = 0.05 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007056

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	C40	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:21 2020 Page 1
ID:17vF7aG0E03cRUj6X1(SrkzWYK-q778eGk1873dG3CXXkLfA19Pt_o08nd2voddJZzNCOi

Scale = 1:17.9

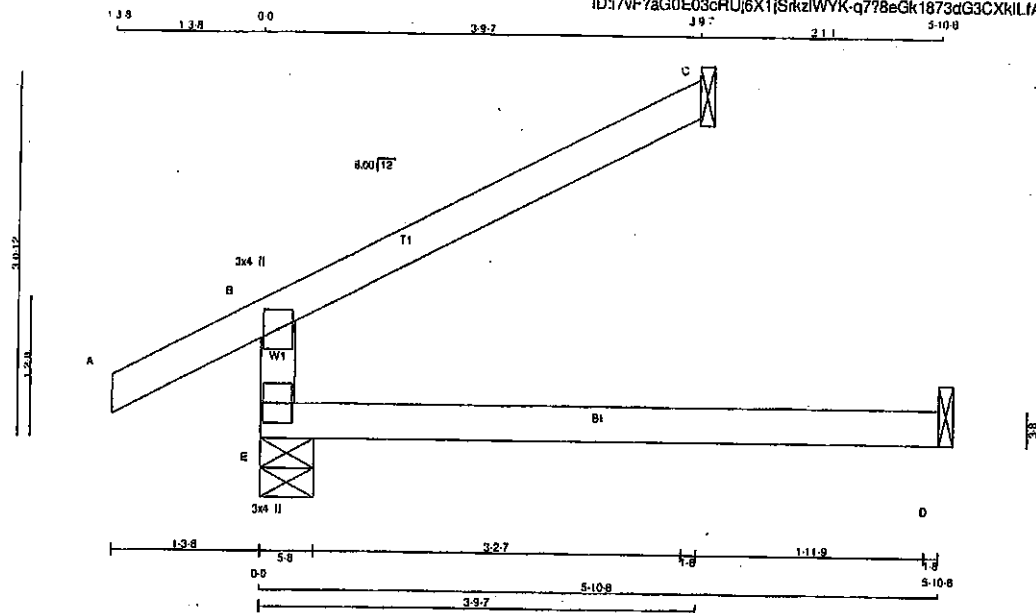

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			SPF
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY, SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
E	405	0	405	0	5-8
C	130	0	130	0	1-8
D	45	0	50	0	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST LCASE	MAX MIN. COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	288	190 / 0	0 / 0	0 / 0	0 / 0	98 / 0	0 / 0
C	90	73 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0
D	38	0 / 0	0 / 0	0 / 0	0 / 0	38 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS			WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB. FR-TO	MAX. FACTORED FORCE (LBS)	MAX FACTORED CSI (LC)
FR-TO		FROM TO					
E-B	-342 / 0	0.0	0.0	0.13 (4)	7.81		
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00		
B-C	-19 / 0	-91.8	-91.8	0.22 (1)	6.25		
E-D	0 / 0	-18.5	-18.5	0.13 (4)	10.00		

TOTAL WEIGHT = 4 X 14 = 57 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSI: TC=0.22/1.00 (B-C:1), BC=0.13/1.00 (D-E:4),
WB=0.00/1.00 (N/A:0), SS1=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES		PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)		
MAX	MIN	MAX	MIN	MAX
MT20	618	354	1667	788
			1987	1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.14 (E) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007098

JOB NAME 408152	TRUSS NAME C41	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 3 Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:23 2020 Page 1 ID:7vF7aG0E03cRUj6X1jSrkzIWYK-nV7u2yIHgJKVNMvRAN7FSFnyoUmch8LN66KNSzNCOg			

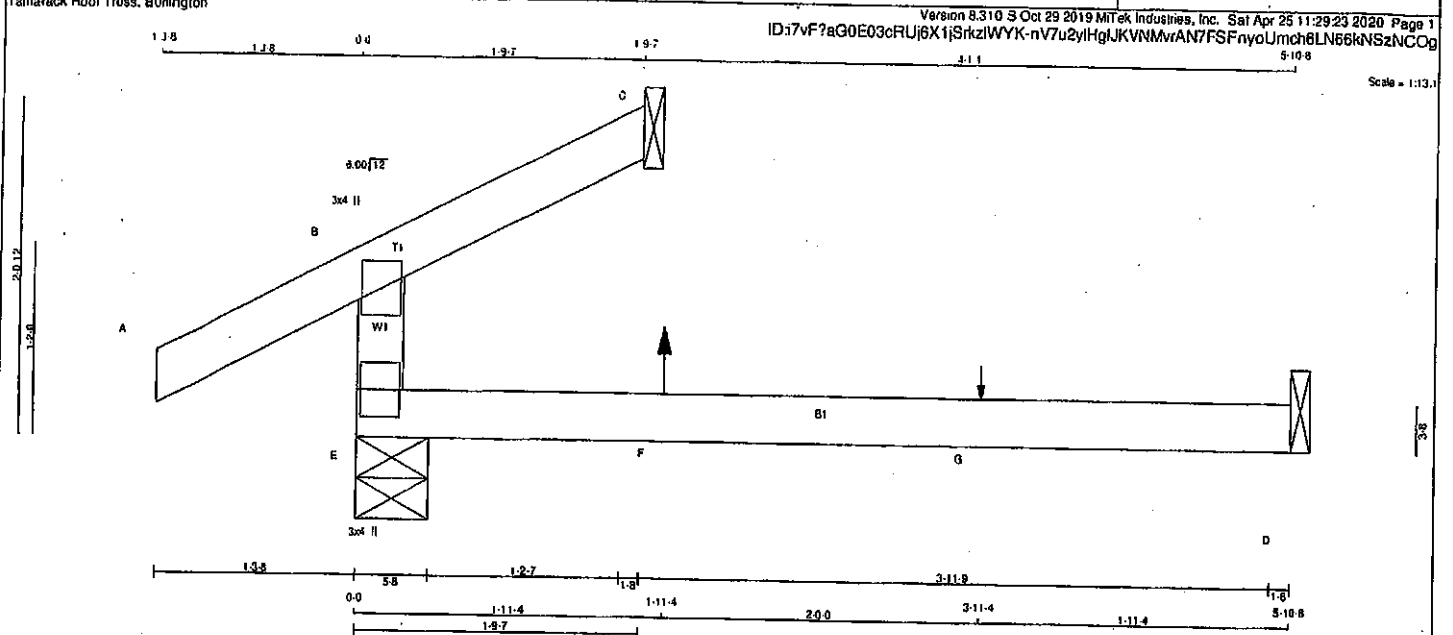

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX
E	284	0	284	0	0	5-8	5-8	
C	63	0	63	0	0	1-8	1-8	
D	44	0	52	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	200	137/0	0/0	0/0	0/0	62/0	0/0
C	45	21/0	0/0	0/0	0/0	25/0	0/0
D	35	0/3	0/0	0/0	0/0	37/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

CHORDS				WEBS			
MEMB.	FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. LC1 MAX. (LC)	MEMB.	FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. (LC)
FR-TO				FR-TO			
E-B	-227/0	0.0	0.0 0.11 (4)	7.81			
A-B	0/28	-91.8	-91.8 0.12 (1)	10.00			
B-C	-9/9	-91.8	-91.8 0.08 (4)	10.00			
E-F	0/0	-18.5	-18.5 0.14 (4)	10.00			
F-G	0/0	-18.5	-18.5 0.14 (4)	10.00			
G-D	0/0	-18.5	-18.5 0.14 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE
F	1-11-4	7	1	12	BACK	VERT	TOTAL
G	3-11-4	1	1	---	BACK	VERT	TOTAL

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.01")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.04")

CSI: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4), WB=0.00/1.00 (Aa:0), SSI=0.09/1.00 (A-B:1)

OOL LUMBER=0.98 NAIL=0.98 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLJ)	(PLJ)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.10 (E) (INPUT = 0.90)
JSI METAL=0.05 (B) (INPUT = 1.00)

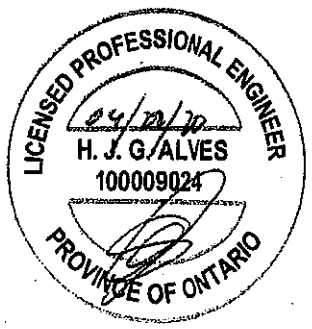


Structural component only
DWG# T-2007099

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408152	C42	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:24 2020 Page 1
ID: J7vF7aG0E03cRUj6X1jS/kzIWK-FhGGHmR2RB7Xx8PivMognw6CsuL8MVcmHwuzNCOI

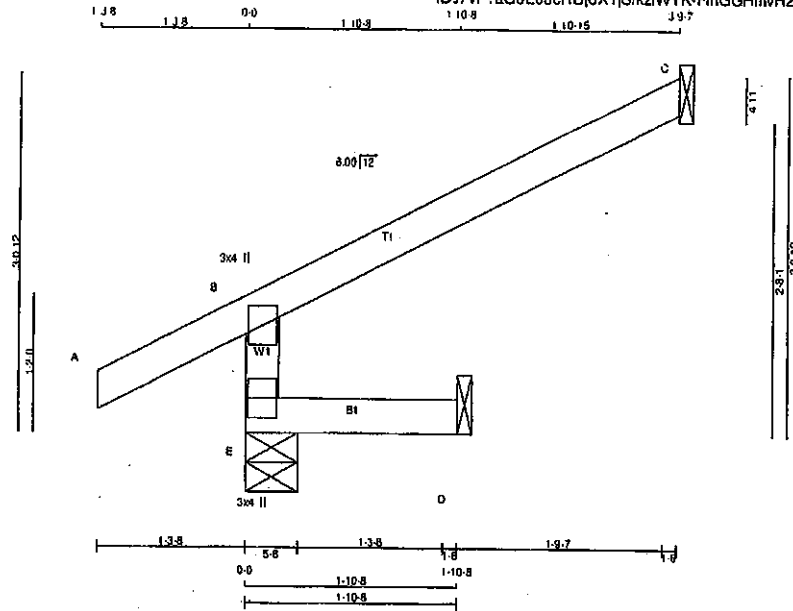

Scale = 1:16.2

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	SPF	SPF
E - B	2x4	DRY	No.2	SPF	SPF
A - C	2x4	DRY	No.2	SPF	SPF
E - D	2x4	DRY	No.2	SPF	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
E	361	0	361	0	0	5-8	5-8	5-8	5-8
C	130	0	130	0	0	1-8	1-8	1-8	1-8
D	18	0	17	0	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST CASE		MAX/MIN. COMPONENT REACTIONS		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	COMBINED	SNOW	LIVE	PERM. LIVE
E	250	190/0	0/0	0/0	0/0	60/0	0/0	250	190/0	0/0	0/0
C	90	73/0	0/0	0/0	0/0	17/0	0/0	90	73/0	0/0	0/0
D	12	0/0	0/0	0/0	0/0	12/0	0/0	12	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	UNBRACED LENGTH FR-TO
FR-TO		FROM	TO	FR-TO			
E-B	-342/0	0.0	0.0	0.01 (4)	7.81		
A-B	0/28	-91.8	-91.8	0.13 (5)	10.00		
B-C	-19/0	-91.8	-91.8	0.22 (1)	6.25		
E-D	0/0	-18.5	-18.5	0.02 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 4 X 10 = 38 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 084-09, CSA 084-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TO=0.22/1.00 (B-C:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1667 788	1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.14 (E) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007100

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	C43	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:25 2020 Page 1
 ID:17vF7aG0E03cRUj6X1jSrklWYK-juEFTdnYCMa2lgWibzQbKtK7UcCo4bceqQbrSKzNCoe

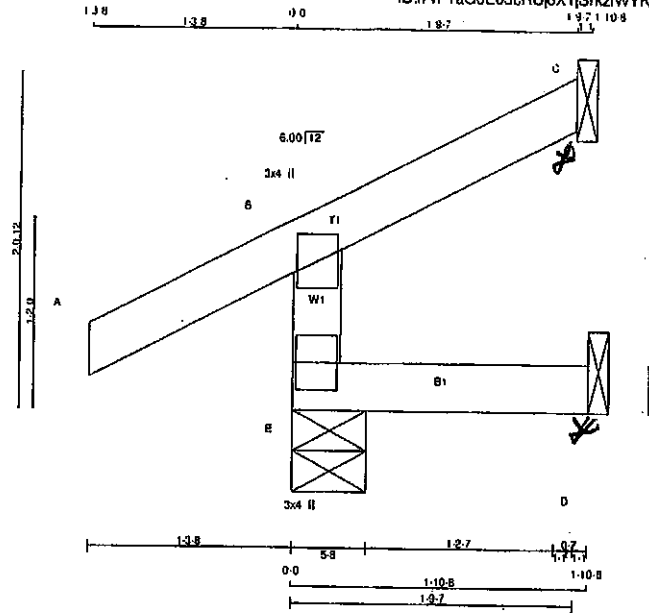

Scale = 1/16"

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	DOWN	UP	IN-SX
E	271	0	0	5-8
C	45	0	0	5-8
D	8	0	0	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT
 PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	188	141 / 0	0 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0
C	31	24 / -18	0 / 0	0 / 0	0 / 0	0 / 0	7 / 0	0 / 0
D	7	0 / -8	0 / 0	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO 2 OR BETTER AT JOINT(S) E, C

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (6)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LG1	MAX. CSI (LC)	UNBRAC LENGTH	MEMB. FORCE (LBS)	MAX. CSI (LC)	WEBS
FR-TO									
E-B		-244 / 0	0.0	0.0	0.04 (5)	7.81			
A-B		0 / 28	-91.8	-91.8	0.12 (1)	10.00			
B-C		-17 / 0	-91.8	-91.8	0.09 (1)	6.25			
E-D		0 / 0	-18.5	-18.5	0.04 (5)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 4 X 7 = 28 lb

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.8 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIG 2011, TPIG 2014

DESIGN ASSUMPTIONS
 - OVERHANG NOT TO BE ALTERED OR CUT OFF.

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
 ALLOWABLE DEFL.(TL) = L/360 (0.19")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5),
 WB=0.00/1.00 (n/a:0), SS=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)
 JSI METAL = 0.07 (B) (INPUT = 1.00)

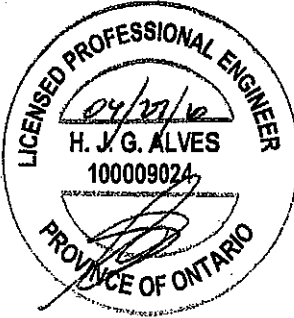


Structural component only
 DWG# T-2007101

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408152	C44	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 11:29:26 2020 Page 1
ID:17vF?aG0E03cRUj8X1jS/kzIWK-B4o1hzoAzgIvMq5UXIxcI5IH1?X4p2sn34KO_nzNCOd

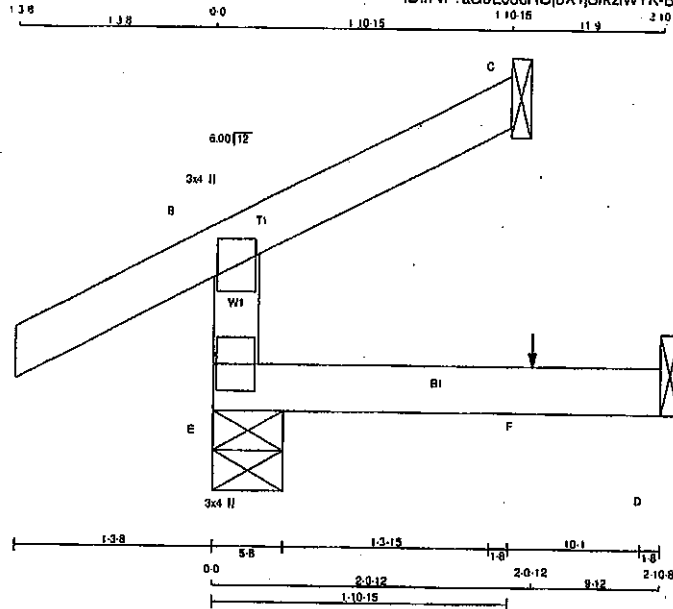

Scale = 1/16"

TOTAL WEIGHT = 2 X 8 = 17 lb

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS			
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)			
JT TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0 4.0
E	BMV+p	MT20	3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
	FACTORED	MAXIMUM FACTORED	INPUT
	GROSS REACTION	GROSS REACTION	BRG
JT	VERT	DOWN	BRG
E	264	0	5-8
C	66	0	1-8
D	23	0	1-8

SEE MTEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS			
JT	1ST CASE	MAX/MIN, COMPONENT REACTIONS	
	COMBINED	SNOW	LIVE
E	185	130/0	0/0
C	48	37/0	0/0
D	18	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PLATE BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS			
MEMB.	MAX. FACTORED	FACTORED	WEBS
	FORCE	VERT. LOAD	MAX. MAX.
	(LBS)	(PLF)	CS1 (LC) UNBRAC
FR-TO		FROM TO	LENGTH FR-TO
E-B	-234/0	0.0 0.0	0.02 (4) 7.81
A-B	0/28	-91.8 -91.8	0.13 (5) 10.00
B-C	-10/0	-91.8 -91.8	0.06 (1) 10.00
E-F	0/0	-18.5 -18.5	0.03 (4) 10.00
F-D	0/0	-18.5 -18.5	0.03 (4) 10.00

FACTORED CONCENTRATED LOADS (LBS)			
JT	LOC.	LC1	MAX.
F	2-0-12	1	1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(66% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.00")

CS1: TC=0.13/1.00 (A-B-5), BC=0.02/1.00 (D-E-4),
WB=0.00/1.00 (NA-0), SS=0.10/1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLU)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)

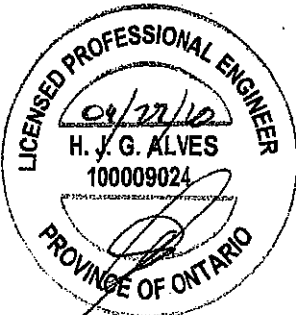

Structural component only
DWG# T-2007102

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	C45	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:27 2020 Page 1	

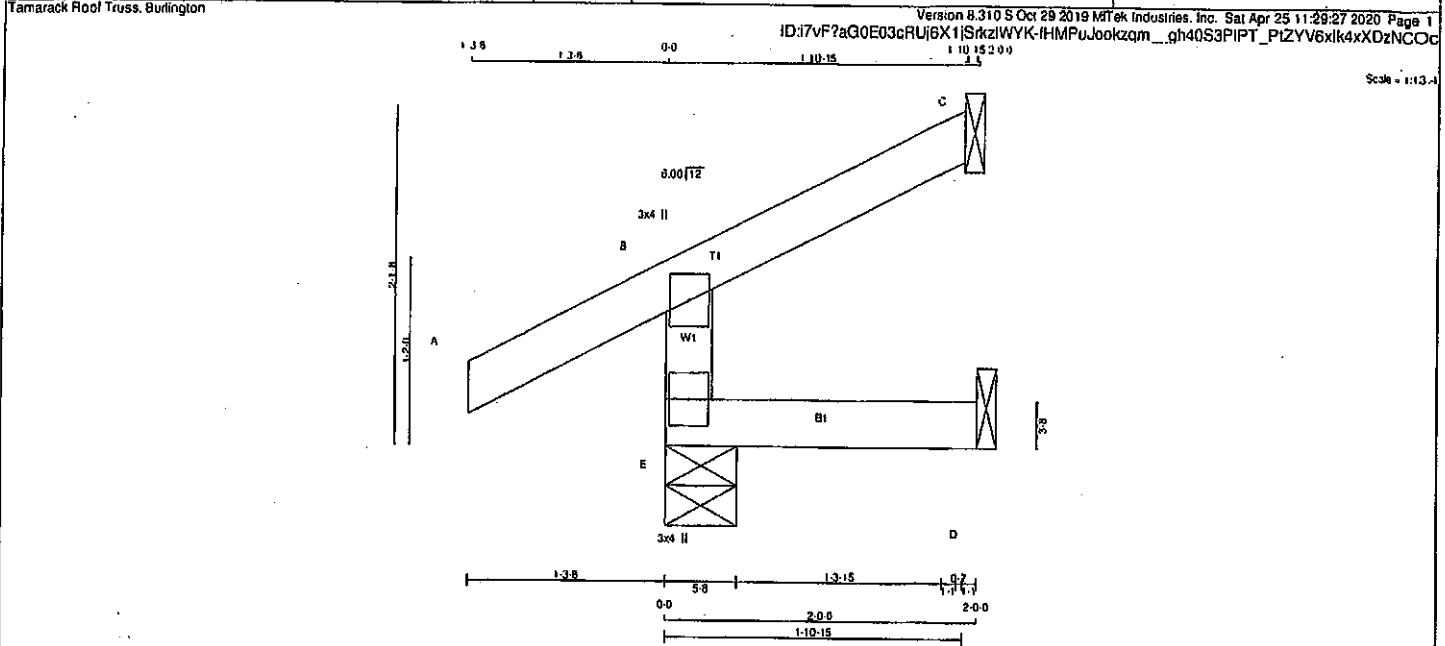

LUMBER			
N. L. G. A. RULES:			
CHORDS	SIZES	LUMBER	DESCR.
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
FACTORED				MAXIMUM FACTORED		INPUT	
GROSS REACTION				GROSS REACTION		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	254	0	254	0	0	5-8	5-8
C	86	0	66	0	0	1-8	1-8
D	16	0	16	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
1ST CASE		MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	177	130/0	0/0	0/0	0/0	47/0	0/0
C	46	37/0	0/0	0/0	0/0	9/0	0/0
D	13	0/0	0/0	0/0	0/0	13/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		FACTORED	
MEMB.		FORCE		MEMB.		FORCE	
FR-TO		(LBS)		FR-TO		(LBS)	
E-B		234/0		E-B		234/0	
A-B		0/26		A-B		0/26	
B-C		-10/0		B-C		-10/0	
E-D		0/0		E-D		0/0	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 2 X 7 = 15 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007103

LUL/LUS/LJS/HUS/HHUS/HGUS

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.

Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on p. 126.




Double-Shear
Nailing
Top View




Double-Shear
Nailing
Side View;
Do not
bend tab




Dome Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,580

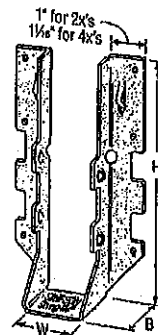


✓ LUS28




LU26L

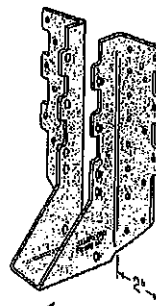

✓ HUS210
(HUS26, HUS28,
and HHUS similar)





✓ HGUS28-2



✓ HHUS210-2

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

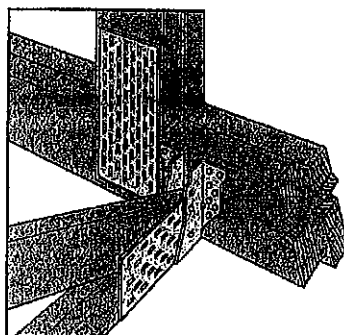

LJS26DS

LUL/LUS/LJS/HUS/HHUS/HGUS**SIMPSON**
Strong-Tie**HHUS/HGUS**

See Hanger Options information on pp. 125–127.


HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
$W < 2"$	Bevel or square cut	0.62 of table value	0.46 of table value
$2" < W < 6"$	Bevel cut	0.67 of table value	0.41 of table value
$2" < W < 6"$	Square cut	0.46 of table value	0.41 of table value
$W > 6"$	Bevel cut	0.75 of table value	0.41 of table value

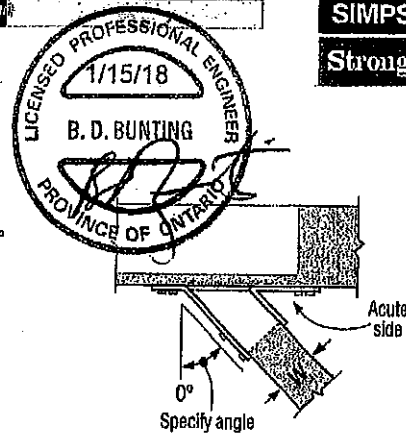**Standard and Double-Shear Joist Hangers (cont.)**

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _e ³	Header	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN	(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN
Single 2x Sizes											
LUS24	18	1 1/8	3 1/4	1 1/4	2 1/4	(4) 10d	(2) 10d	710 3.16	1626 7.23	645 2.87	1155 5.14
LU24L	22	1 1/8	3	1 1/8	2 1/8	(4) 10d	(2) 10d x 1 1/2"	360 1.60	1020 4.54	320 1.42	725 3.22
LU26L	22	1 1/8	5	1 1/8	4 1/8	(6) 10d	(4) 10d x 1 1/2"	720 3.20	1805 7.14	645 2.87	1140 5.07
LUS26	18	1 1/8	4 1/4	1 1/4	3 3/4	(4) 10d	(4) 10d	1420 6.32	2170 9.65	1290 5.74	1630 7.25
HUS28	18	1 1/8	5 3/8	3	3 1/8	(14) 16d	(8) 16d	2705 11.80	4940 21.97	2065 9.20	3875 17.24
LJS26DS	18	1 1/8	5	3 1/2	4 1/8	(16) 16d	(8) 16d	2055 9.14	4265 18.97	1480 6.49	4115 18.31
HGUS26	12	1 1/8	5 3/8	5	4 1/8	(20) 16d	(8) 16d	2885 11.96	6625 29.51	2685 11.86	5700 25.35
LU28L	20	1 1/8	6 3/4	1 1/8	5 1/8	(8) 10d	(6) 10d x 1 1/2"	1140 5.07	2185 9.72	1020 4.54	1550 6.89
LUS28	18	1 1/8	6 1/4	1 1/4	3 3/4	(6) 10d	(4) 10d	1420 6.32	2520 11.21	1290 5.74	1790 7.96
HUS28	16	1 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3605 16.04	5365 23.86	2875 11.90	4345 19.33
HGUS28	12	1 1/8	7 1/4	5	6 1/8	(36) 16d	(12) 16d	3310 14.74	7675 34.19	3310 14.74	6900 30.73
LU210L	20	1 1/8	8	1 1/8	7 1/8	(10) 10d	(6) 10d x 1 1/2"	1140 5.07	2495 11.10	1020 4.54	1770 7.87
LUS210	18	1 1/8	7 1/8	1 1/4	3 3/4	(8) 10d	(4) 10d	1420 6.32	2785 12.39	1290 5.74	2210 9.83

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.

2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.

3. d_e is the distance from the bearing seat to the top joist nail.

4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.


5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _a ³	Header	Joist	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _Q = 1.15)	(K _Q = 1.00)	(K _Q = 1.15)	(K _Q = 1.00)
								lb.	lb.	lb.	lb.
								kN	kN	kN	kN
Double 2x Sizes											
LUS24-2	18	3 1/8	3 1/8	2	1 1/2	(4) 16d	(2) 16d	835	2020	590	1435
								3.71	8.99	2.62	6.38
SS LUS26-2	18	3 1/8	4 1/8	2	4	(4) 16d	(4) 16d	1720	2595	1545	1920
								7.65	11.54	6.87	8.64
HHUS26-2	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	2850	7335	2065	5205
								12.68	32.63	9.20	23.15
HGUS26-2	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
SS LUS28-2	18	3 1/8	7	2	4	(6) 16d	(4) 16d	1720	3325	1545	2575
								7.65	14.79	6.87	11.45
HHUS28-2	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3785	8940	2675	6345
								16.75	39.77	11.90	28.22
HGUS28-2	12	3 1/8	7 1/8	4	8 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
SS LUS210-2	18	3 1/8	9	2	6	(8) 16d	(6) 16d	2580	4500	2320	3195
								11.48	20.02	10.32	14.21
HHUS210-2	14	3 1/8	9 1/8	3	8	(30) 16d	(10) 16d	4670	9670	4235	7000
								20.77	42.97	18.84	31.14
HGUS210-2	12	3 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	6840	14015	4855	10270
								30.43	62.34	21.60	45.69
Triple 2x Sizes											
HGUS26-3	12	4 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-3	12	4 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d	4670	9670	4235	6965
								20.77	42.92	18.84	30.54
HGUS210-3	12	4 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.26
Quadruple 2x Sizes											
HGUS26-4	12	6 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-4	12	6 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-4	14	6 1/8	8 1/8	3	7 1/8	(30) 16d	(10) 16d	4670	10155	4235	7210
								20.77	45.17	18.84	32.07
HGUS210-4	12	6 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.26
HGUS212-4	12	6 1/8	10 1/8	4	10 1/8	(50) 16d	(20) 16d	7840	14995	5425	10845
								33.98	66.70	24.13	47.35
HGUS214-4	12	6 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	51.80
4x Sizes											
LUS46	18	3 1/8	4 1/8	2	3 1/8	(4) 16d	(4) 16d	1720	2595	1545	1920
								7.65	11.54	6.87	8.64
HHUS46	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	2850	7335	2065	5205
								11.30	32.63	9.20	23.15
HGUS46	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
LUS48	18	3 1/8	6 1/8	2	3 1/8	(6) 16d	(4) 16d	1720	3325	1545	2575
								7.65	14.79	6.87	11.45
HHUS48	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3785	8940	2675	6345
								16.75	39.77	11.90	28.22
HGUS48	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
LUS410	18	3 1/8	8 1/8	2	5 1/8	(8) 16d	(6) 16d	2580	4500	2320	3195
								11.48	20.02	10.32	14.21
HGUS410	12	3 1/8	9	4	8 1/8	(46) 16d	(16) 16d	6840	14015	4855	10270
								30.43	62.34	21.60	45.69
HGUS412	12	3 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	7840	14995	5425	10845
								33.98	66.70	24.13	47.35
HGUS414	12	3 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	51.80



Plated Truss Connectors

See footnotes on p. 258.

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1 1/4". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA Q86-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

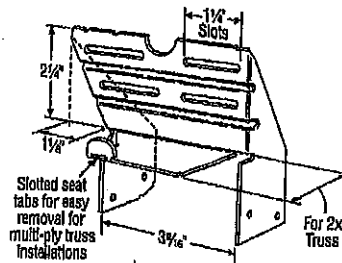


TC24
U.S. Patent 4,932,173

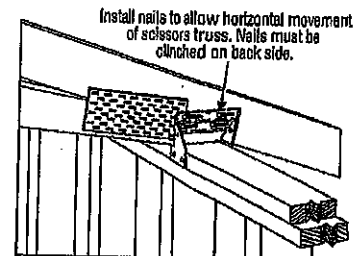


Typical TC24 Installation

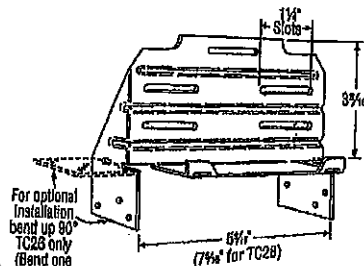

TC28
(TC28 Similar)

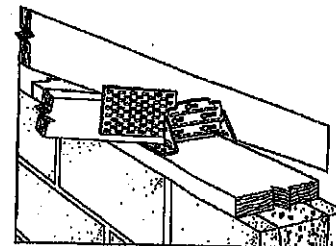

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer
(8", 10", 12" Wall Installation Similar)

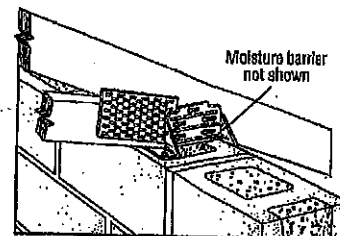

Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _o =1.15)	Uplift (K _o =1.15)
TC24	(4) 10d	(4) 10d	605	430
TC26	(6) 10d	(6) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _o =1.15)	Uplift (K _o =1.15)
TC26	(5) 10d	(6) 10d x 1 1/2"	810	660
	(5) 10d	(6) 10d	930	660

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.
2. Grout strength is 15 MPa minimum.
3. Optional TC26 installation with 10d nails requires minimum 3" top plate thickness.
4. TC26 fastened to grouted concrete block with (6) - 3/4" x 2 1/4" Titen screws has a factored uplift resistance of 275 lb.



(800) 999-5099
strongtie.com

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_D = 1.15$)					
					D.Fir-L			S-P-F		
		To Rafters/Truss	To Plates	To Studs	Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(5) 8d x 1½"	(4) 8d	—	740	685	300	680	485	215
					3.29	3.05	1.33	3.02	2.16	0.96
SS H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
					3.58	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	180	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	265	615	125	190
					3.29	0.80	1.18	2.74	0.56	0.85
H6	16	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	670	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS H8 ³	18	(5) 10d x 1½"	(5) 10d x 1½"	—	1120	—	—	1025	—	—
					4.98	—	—	4.56	—	—
SS H10A ³	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	565	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.54	1.36
H10A-2	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1835	1275	430	1045	880	305
					8.16	5.67	1.91	7.32	3.91	1.36
H10S ^{2,3}	18	(8) 8d x 1½"	(8) 8d x 1½"	(8) 8d	1465	795	315	1040	565	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(8) 16d x 2½"	(6) 16d x 2½"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	[1] (12) 8d x 1½"	(13) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
		[2] (12) 8d x 1½"	(15) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
TSP	16	(9) 10d x 1½"	(6) 10d x 1½"	—	1295	440	—	920	310	—
					5.76	1.98	—	4.09	1.38	—
		(9) 10d x 1½"	(6) 10d	—	1560	440	—	1105	310	—
					6.94	1.98	—	4.92	1.38	—

- Factored resistances have been increased 15% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 595 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTIECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 8/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1½" nails into the top plates and (3) 8d x 1½" nails into the lowest three flange holes into the truss bottom chord is 495 lb. (2.20 kN).
- Nails: 16d x 2½" = 0.182" dia. x 2½" long, 10d = 0.148" dia. x 3" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long, 8d x 1½" = 0.131" dia. x 1½" long. See pp. 27–28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

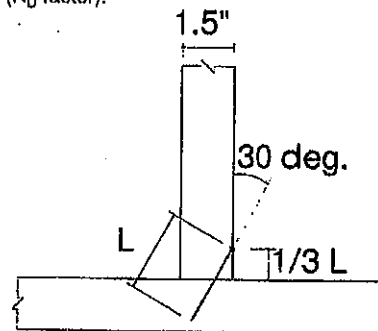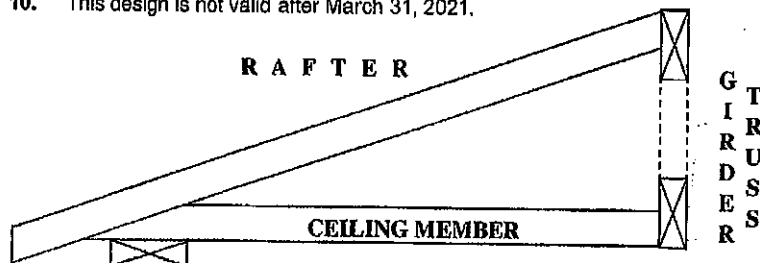


TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019.



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind** or **earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

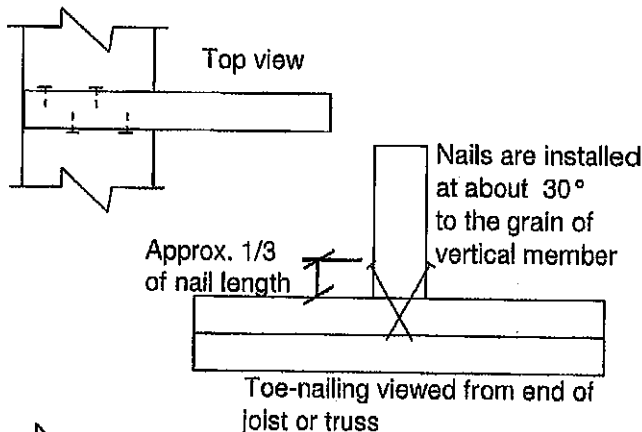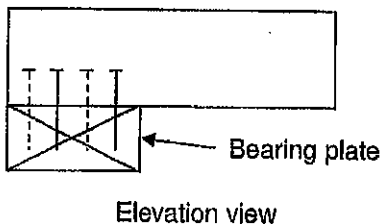

Toe-nailing on 2x4 Bearing Plate

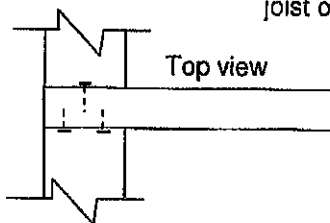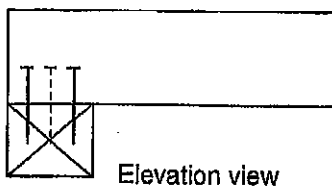

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7


PEO
Certificate No. 10889485




December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint, unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/4" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

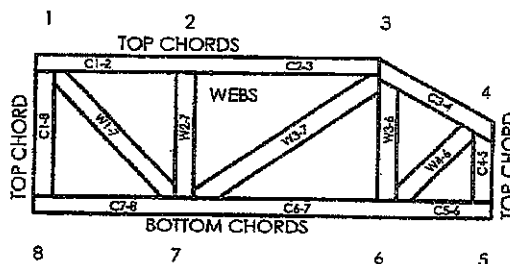

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MH-7473C rev. 10-08



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See 8CSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

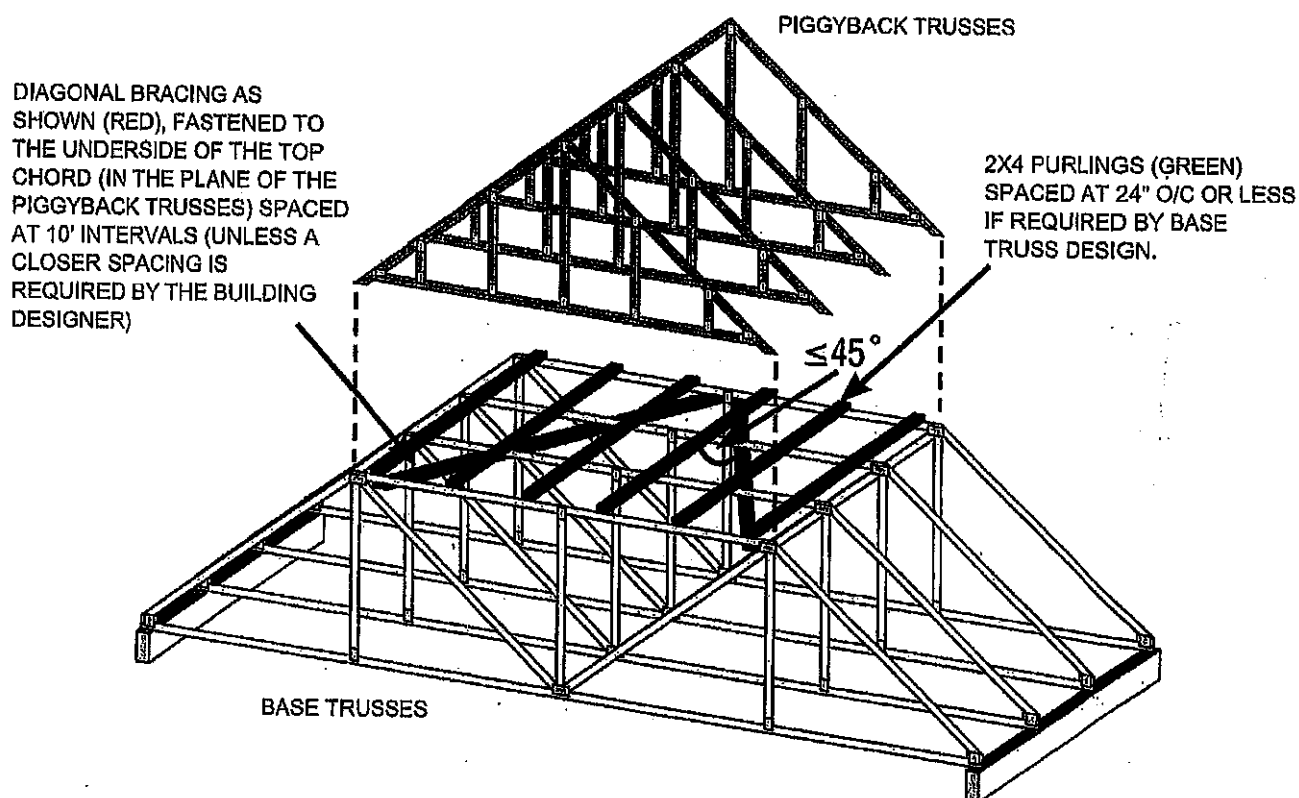


NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet M117473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

F-1900213

Feb 09, 2018