

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 6
 Lot #: 311
 Elevation: 2-STD OR OPT.5 BR

Job Track: 51225
 PlanLog: 202419
 Layout ID: 408223
 Ref #
 Page: 1 of 3
 Date: 04-28-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	T11B Common	8 /12	16-01-00	6-09-13	2 x 4		1-06-02 1-04-13	137.47 88.33		
	3	T11S Roof Special	8 /12 8 /12	16-03-00	6-09-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	201.4 133.00		
	1 2-ply	T20 Hip Girder	7 /12	35-02-00	4-01-04	2 x 6	1-03-08 1-03-08	1-03-07 1-03-07	359.46 218.00		
	1	T21 Hip	7 /12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-03-07 1-03-07	142.49 89.50		
	1	T22 Hip	7 /12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-03-07 1-03-07	146.47 93.50		
	1	T23 Hip	7 /12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-03-07 1-03-07	144.95 91.17		
	1	T24 Hip	7 /12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-03-07 1-03-07	151.12 95.67		
	4	T25 Hip	7 /12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-03-07 1-03-07	631.9 399.33		
	3	T25A Piggyback Base	7 /12	34-10-00	9-01-04	2 x 4		1-04-09 1-04-09	461.61 286.50		
	1 2-ply	T28 Flat Girder	0 /12	34-10-00	4-10-07	2 x 6		4-10-07 4-10-07	366.38 214.67		
	2	T29 Flat	0 /12	34-10-00	6-06-07	2 x 4		6-06-07 6-06-07	313.97 193.33		
	2	T30 Flat	0 /12	34-10-00	8-02-07	2 x 4		8-02-07 8-02-07	368.85 220.00		
	5	T31 Flat	0 /12	34-10-00	9-10-07	2 x 4		9-10-07 9-10-07	980.54 600.00		
	1	T32 Hip Girder	8 /12	12-02-00	6-04-07	2 x 4 2 x 6		3-00-02 2-10-13	68.45 43.67		



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 6
 Lot #: 311
 Elevation: 2-STD OR OPT.5 BR

Job Track: 51225
 PlanLog: 202419
 Layout ID: 408223
 Ref #
 Page: 2 of 3
 Date: 04-28-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	T34S Half Hip	10/12	3-10-08	5-05-13	2 x 4	1-03-08	1-07-11 5-05-13	63.75 44.33		
	2	T35S Half Hip	10/12	3-10-08	4-01-13	2 x 4	1-03-08	1-07-11 4-01-13	57.2 41.00		
	3	T36 Common	6/12	8-03-08	3-00-09	2 x 4	1-03-08 1-03-08	5-07 5-07	79.61 53.00		
	1	G36 GABLE	6/12	8-03-08	3-01-05	2 x 4	1-03-08 1-05-00	5-07 5-07	26.83 17.33		
	1	T37 Half Hip Girder	8/12	8-05-00	2-08-03	2 x 4 2 x 6	1-03-08	8-05 2-01-15	36.62 26.00		
	2	G39 GABLE	10/12	27-06-00	9-10-07	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	303.3 183.33		
	17	P20 Common	10/12	7-08-14	3-02-12	2 x 4		0-01 0-01	363.26 229.50		
	4	PB20 Piggyback	7/12	8-04-05	2-05-04	2 x 4			80.17 49.33		
	1	PB22 Piggyback	7/12	8-04-05	1-00-00	2 x 4			18.26 11.67		
	1	PB21 Piggyback	7/12	8-04-05	2-00-00	2 x 4			21.88 14.33		
	2	PG20 GABLE	10/12	7-09-00	3-02-12	2 x 4			44.53 30.33		
	17	J1 Jack-Open	6/12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	285.51 181.33		
	2	J20S Jack-Open	10/12	3-10-08	6-04-07	2 x 4	1-03-08	1-07-11 6-04-07	65.13 43.33		
	4	J21 Jack-Open	5/12	4-04-08	2-08-02	2 x 4	1-03-08	4-01 2-01-15	48.51 32.00		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 6
 Lot #: 3 //
 Elevation: 2-STD OR OPT.5 BR

Job Track: 51225
 PlanLog: 202419
 Layout ID: 408223
 Ref #
 Page: 3 of 3
 Date: 04-28-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	3	J22 Jack-Open	10 / 12	3-10-08	4-10-07	2 x 4	1-03-08	1-07-11 4-10-07	45.68 29.00		

TOTAL # TRUSS= 92

TOTAL BFT OF ALL TRUSSES= 3762.48 BFT.

TOTAL WEIGHT OF ALL TRSSES 6003.41 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
3	Hardware	LJS26DS	
4	Hardware	LUS24	
2	Hardware	LUS26-2	

TOTAL NUMBER OF
ITEMS= 9



V-AH	0 0	-18.5	-18.5	0.04(4)	10.00
AH-U	0 0	-18.5	-18.5	0.04(4)	10.00
U-AI	0 3325	-18.5	-18.5	0.25(1)	10.00
AJ-AJ	0 3325	-18.5	-18.5	0.25(1)	10.00
AI-T	0 3325	-18.5	-18.5	0.25(1)	10.00
T-AK	0 6074	-18.5	-18.5	0.45(1)	10.00
AK-S	0 6074	-18.5	-18.5	0.45(1)	10.00
S-AL	0 6074	-18.5	-18.5	0.45(1)	10.00
AL-R	0 6074	-18.5	-18.5	0.45(1)	10.00
R-AM	0 7813	-18.5	-18.5	0.57(1)	10.00
AM-AN	0 7813	-18.5	-18.5	0.57(1)	10.00
AN-AO	0 7813	-18.5	-18.5	0.57(1)	10.00
AO-C	0 7813	-18.5	-18.5	0.57(1)	10.00
C-AP	0 6040	-18.5	-18.5	0.45(1)	10.00
AP-P	0 6040	-18.5	-18.5	0.45(1)	10.00
P-AQ	0 6040	-18.5	-18.5	0.45(1)	10.00
AQ-O	0 6040	-18.5	-18.5	0.45(1)	10.00
O-AR	0 3281	-18.5	-18.5	0.25(1)	10.00

JSI GRIP = 0.86 (J) INPUT = 0.80 ;
JSI METAL = 0.58 (P) INPUT = 1.00 ;

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T1	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:00:04 2020 Page 2

ID:DMCubINVR6TsFoe31v6I zns11-Jm9J91AhZi22q2EEmlNZgEz3HTHf7mEdCAUJvczMFIf

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	8.0	1.50	3.00
C	TTWW+m	MT20	7.0	8.0	Edge	2.50
D, F, I						
D	TMWV-t	MT20	4.0	4.0		
E	TMW+w	MT20	2.0	4.0		
G	TS-t	MT20	3.0	8.0		
H	TMW+w	MT20	2.0	4.0		
J	TTWW+m	MT20	7.0	8.0	Edge	2.50
K	TMWV-p	MT20	5.0	8.0	1.50	3.00
M	BMV1+p	MT20	3.0	6.0		
N, O, T, U						
N	BMWV-t	MT20	5.0	6.0		
P	BS-t	MT20	5.0	8.0		
Q	BMWVW-t	MT20	5.0	8.0		
R	BMWVW-t	MT20	5.0	8.0		
S	BS-t	MT20	5.0	6.0		
V	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CS1 (LC)	MAX. UNBRAC LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO			FR-TO		
AR-AS	0 3261	-18.5 -18.5	0.25 (1)	10.00			
AS-N	0 3261	-18.5 -18.5	0.25 (1)	10.00			
N-AT	0 0	-18.5 -18.5	0.04 (4)	10.00			
AT-AU	0 0	-18.5 -18.5	0.04 (4)	10.00			
AU-M	0 0	-18.5 -18.5	0.04 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DJR.	TYPE	HEEL	CONN.
C	4-0-10	-49	-55	---	FRONT	VERT	DEAD	---	C1
C	4-0-10	-117	-117	---	FRONT	VERT	TOTAL	---	C1
C	4-0-10	-254	-254	---	FRONT	VERT	SNOW	---	C1
G	17-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
I	25-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
J	31-1-8	-49	-55	---	FRONT	VERT	DEAD	---	C1
J	31-1-8	-254	-254	---	FRONT	VERT	SNOW	---	C1
O	25-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
S	11-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
U	3-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
W	5-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	19-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	21-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	23-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	27-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AG	29-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AH	1-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AI	5-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AJ	7-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AK	9-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AL	13-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AM	15-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AN	17-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AO	19-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AP	21-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AQ	23-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AR	27-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AS	29-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AT	31-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AU	33-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007602 7/2

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:00:05 2020 Page 1

ID:DMCubINVR6Ts1v6zns11-nyjhmNBjKcAvHCpQKtuoORWDoScNkApnRqDRR2zMF1e

1-3-8 0-0 4-0-10 5-3-4 7-3-4 9-3-12 14-9-8 17-7-0 20-4-8 25-10-4 32-2 38-8

1-3-8 4-0-10 6-2-10 2-0-0 2-0-8 5-6-12 2-8 15-12 32-2 40-10 1-3-8

Scale = 1/8" = 1'-0"



DRY, SEASONED LUMBER. BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V. M. SPACING = 24.0 IN. C/C

CHORDS #ROWS	SURFACE	LOAD(PLF)	ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.	*** NON STANDARD GIRDER *** APPLY WELD REQUIRED LOADS APPLIED TO ALL
--------------	---------	-----------	--	---

NAI L S TO BE DRIVEN FROM ONE SIDE ONLY.	F-G	-6928	0	-91.8	-91.8	0.28 (1)	3.57	N-K	0	2693	0.33 (1)
	G-H	-6926	0	-91.8	-91.8	0.28 (1)	3.57	Q-I	0	2133	0.28 (1)

ALLOWABLE DEFL.(LL)= L/360 (11.17")

TOP - COMPONENTS ARE LOADED FROM THE TOP AND

1-2	0 0	-18.5	-18.5	0.05 (1)	10.00
Z-U	0 0	-18.5	-18.5	0.05 (4)	10.00
11-11	0 3227	-18.5	-18.5	0.35 (1)	10.00

COMPANION LIVE LOAD FACTOR = 1.00


S-R	0-8135	-18.5	-18.5	0.61 (1)	10.00	TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE
R-Q	0-7645	-18.5	-18.5	0.55 (1)	10.00	

H. J. G. ALVES		N-M		-16.5		-16.5		0.03 (4)		10.00		FATE		GRIFIDITY		SHEAR		SECTION	
100000024		SAGGERS		CONCENTRATED		LOADS		(185)				(PSI)		(PLI)		(PLI)			
												MAX. MIN.		MAX. MIN.		MAX. MIN.			

T	9-2-8	-2179	-2179	---	BACK	VERT	TOTAL	---	C1
W	5-3-4	-110	-110	---	BACK	VERT	TOTAL	---	C1

PLATE ROTATION TOL. = 5.0 Deg.

Structural component only	AA	5-3-4	-28	-28	...	BACK	VERT	TOTAL	...	C1
	AB	7-3-4	-28	-28	...	BACK	VERT	TOTAL	...	C1



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T1Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:05 2020 Page 2

ID:DMCubINVR6tstFoe31v6l_zns1l-nvjhMNBjKcAvHCPQKTuoORWDosclKApnRqDRR2zMFle

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TTWW-m	MT20	6.0	9.0	1.75	3.50
D	TMWW-i	MT20	4.0	6.0		
E	TMW-w	MT20	2.0	4.0		
F	TMWW-i	MT20	4.0	4.0		
G	TS-t	MT20	3.0	6.0		
H	TMW-w	MT20	2.0	4.0		
I	TMWW-i	MT20	4.0	6.0		
J	TTWW-m	MT20	6.0	9.0	1.75	3.50
K	TMVW-p	MT20	5.0	8.0	Edge	
M	BMV1-p	MT20	3.0	6.0		
N	BMWW-i	MT20	5.0	6.0	2.50	2.25
O	BMWW-i	MT20	6.0	9.0	4.50	2.50
P	BS-t	MT20	5.0	6.0		
Q	BMWWW-i	MT20	5.0	8.0		
R	BMWWW-i	MT20	5.0	8.0		
S	BS-t	MT20	5.0	6.0		
T	BMWW-i	MT20	6.0	9.0	4.50	2.50
U	BMWW-i	MT20	5.0	6.0	2.50	2.25
V	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.


CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007603 7/2

JOB NAME 408222	TRUSS NAME T2	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Tue Apr 28 09:00:06 2020 Page 1	
ID:DMCubINVR6TsiF0a31v6I zns11-F8H4ajCx5wlmvMOcuAP1x12LGGy5TgYwUz? U2MFid				35-2.0 35-5.8 1-3.8	
1-3.8 0-0 5-6-10 5-6-10 5-9-13 11-7-7 5-11-9 17-7-0 5-11-9 23-6-9 8-0-13 29-7-6 5-9-10 35-2.0				Scale = 1:57.6	

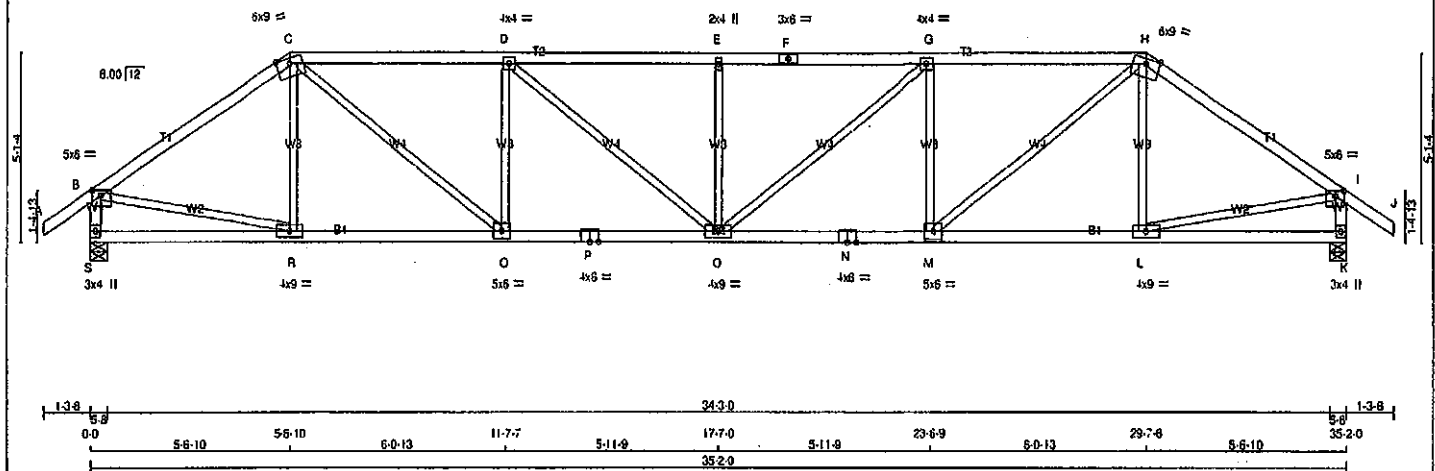

LUMBER		CHORDS		SIZE		DRY		LUMBER		DESCR	
N. L. G. A. RULES		A - C		2x4		DRY		No.2		SPF	
A - C		2x4		DRY		No.2		SPF		JT	
F - H		2x4		DRY		No.2		SPF		S	
H - J		2x4		DRY		No.2		SPF		K	
S - B		2x4		DRY		No.2		SPF			
K - I		2x4		DRY		No.2		SPF			
S - P		2x4		DRY		No.2		SPF			
P - N		2x4		DRY		No.2		SPF			
N - K		2x4		DRY		No.2		SPF			
ALL WEBS EXCEPT		2x3		DRY		No.2		SPF			

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-p	MT20	5.0	6.0	1.75	2.75
C	TTWW-m	MT20	6.0	9.0	Edge	
D	TMVW-t	MT20	4.0	4.0		
E	TMVW-w	MT20	2.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMVW-t	MT20	4.0	4.0		
H	TTWW-m	MT20	6.0	9.0	Edge	
I	TMVW-p	MT20	5.0	6.0	1.75	2.75
K	BMV1-p	MT20	3.0	4.0		
L	BMVW-t	MT20	4.0	9.0		
M	BMVW-t	MT20	5.0	6.0		
N	BS-t	MT20	4.0	6.0		
O	BMVWV-t	MT20	4.0	9.0		
P	BS-t	MT20	4.0	6.0		
Q	BMVW-t	MT20	5.0	6.0		
R	BMVW-t	MT20	4.0	9.0		
S	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	UP	IN-SX	IN-SX	IN-SX
S	2065	0	2065	0	5-8	5-8	5-8
K	2065	0	2065	0	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1458	970	0	0	0	488	0
K	1458	970	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.97 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE	VERT.	LOAD	LC1	MAX	MEMB.	FORCE	VERT.	LOAD
(LBS)	(PLF)	(LBS)	(LBS)	(LBS)	(LBS)	(LBS)	(LBS)	(LBS)	(LBS)
FR-TO						FR-TO			
A-B	0	35	-91.8	-91.8	0.12 (1)	10.00	R-C	-243	10
B-C	-2296	0	-91.8	-91.8	0.70 (1)	3.78	C-Q	0	1670
C-D	-3213	0	-91.8	-91.8	0.80 (1)	3.19	Q-D	-929	0
D-E	-3594	0	-91.8	-91.8	0.88 (1)	2.97	D-O	0	490
E-F	-3594	0	-91.8	-91.8	0.88 (1)	2.97	O-E	-505	0
F-G	-3594	0	-91.8	-91.8	0.88 (1)	2.97	G-O	0	490
G-H	-3213	0	-91.8	-91.8	0.80 (1)	3.19	M-G	-929	0
H-I	-2296	0	-91.8	-91.8	0.70 (1)	3.78	M-H	0	1670
I-J	0	35	-91.8	-91.8	0.12 (1)	10.00	L-H	-243	10
S-B	-2023	0	0.0	0.0	0.21 (1)	5.94	B-R	0	1943
K-I	-2023	0	0.0	0.0	0.21 (1)	5.94	L-I	0	1943
S-R	0	0	-18.5	-18.5	0.15 (4)	10.00			
R-Q	0	1903	-18.5	-18.5	0.39 (1)	10.00			
Q-P	0	3213	-18.5	-18.5	0.58 (1)	10.00			
P-O	0	3213	-18.5	-18.5	0.58 (1)	10.00			
O-N	0	3213	-18.5	-18.5	0.58 (1)	10.00			
N-M	0	3213	-18.5	-18.5	0.58 (1)	10.00			
M-L	0	1903	-18.5	-18.5	0.39 (1)	10.00			
L-K	0	0	-18.5	-18.5	0.15 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
OL = 6.0 PSF
BOT CH. LL = 0.0 PSF
OL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/989 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/989 (0.39")

CSI: TC=0.86/1.00 (D-E:1), BC=0.58/1.00 (M-O:1), WB=0.44/1.00 (L-I:1), SSI=0.26/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.87 (I) (INPUT = 0.90)
JSI METAL= 0.74 (F) (INPUT = 1.00)



Structural component only
DWG# T-2007604

JOB NAME 408222	TRUSS NAME T3	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 \$ Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:00:06 2020 Page 1
 ID:DMCubINVR6TstFos31v6l_zns11-F8H4ajCx5wlmvMOcuAP1xt2QrG_VTXHwIjz7_UzMFid
 1-3-8 0-0 3-7-9 3-7-9 3-5-1 7-0-10 5-3-13 12-4-7 5-2-9 17-7-0 5-2-9 22-3-9 5-3-13 28-1-6 3-5-1 31-9-7 35-2-0 38-5-8
 Scale = 1:57.6

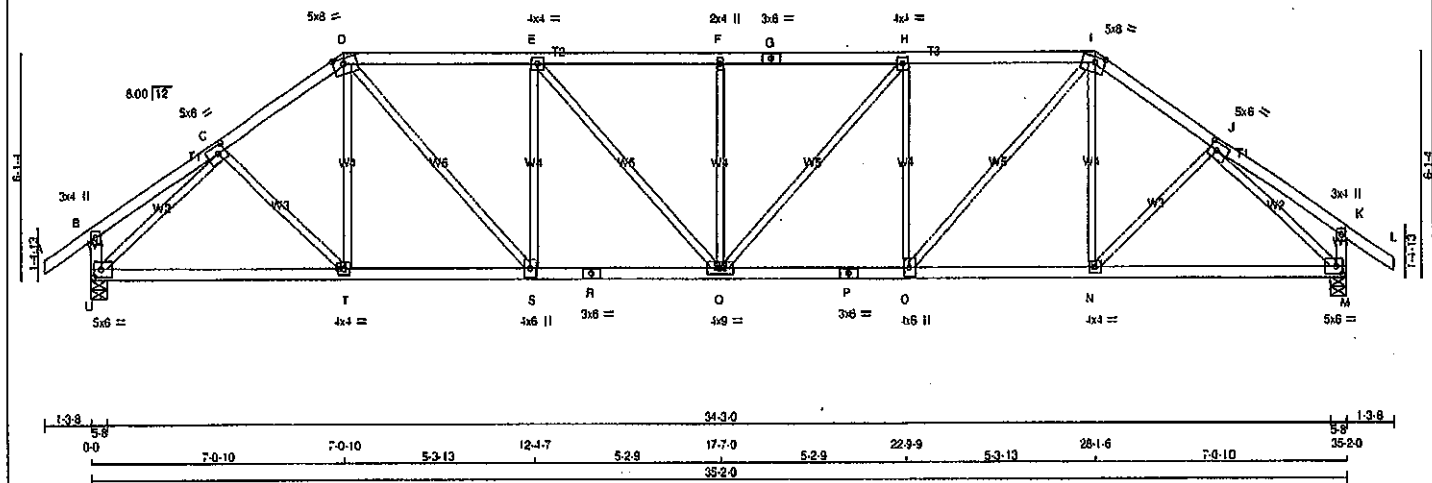

TOTAL WEIGHT = 2 X 151 = 303 lb (M)

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
U - B	2x4	DRY	No.2
M - K	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - P	2x4	DRY	No.2
P - M	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	HORZ	UP/LIFT	IN-SX	BRG	IN-SX
U	2065	0	2065	0	0	5-8	5-8	5-8	5-8
M	2065	0	2065	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST CASE		MAX. MIN. COMPONENT REACTIONS		LIVE		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	COMBINED
U	1458	970	0	0	0	0	0	1458	970	0	0	0	0	0	1458
M	1458	970	0	0	0	0	0	1458	970	0	0	0	0	0	1458

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.53 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)
FR-TO		FROM TO	LENGTH	FR-TO		FROM TO	LENGTH
A-B	0 35	-91.8 -91.8	0.12 (1)	10.00	C-T	0 135	0.03 (4)
B-C	0 18	-91.8 -91.8	0.16 (1)	10.00	T-D	0 90	0.03 (4)
C-D	-2305 0	-91.8 -91.8	0.23 (1)	4.31	D-S	0 1218	0.27 (1)
D-E	-2723 0	-91.8 -91.8	0.54 (1)	3.69	S-E	-814 0	0.48 (1)
E-F	-2986 0	-91.8 -91.8	0.56 (1)	3.53	E-Q	0 363	0.08 (1)
F-G	-2986 0	-91.8 -91.8	0.56 (1)	3.53	Q-F	-440 0	0.28 (1)
G-H	-2986 0	-91.8 -91.8	0.56 (1)	3.53	Q-H	0 363	0.08 (1)
H-I	-2723 0	-91.8 -91.8	0.54 (1)	3.69	H-I	-814 0	0.48 (1)
I-J	-2305 0	-91.8 -91.8	0.23 (1)	4.31	O-I	0 1218	0.27 (1)
J-K	0 18	-91.8 -91.8	0.16 (1)	10.00	N-I	0 90	0.03 (4)
K-L	0 35	-91.8 -91.8	0.12 (1)	10.00	N-J	0 135	0.03 (4)
U-B	-255 0	0.0 0.0	0.03 (1)	7.81	U-C	-2514 0	0.97 (1)
M-K	-255 0	0.0 0.0	0.03 (1)	7.81	J-M	-2514 0	0.97 (1)
U-T	0 1801	-18.5 -18.5	0.40 (1)	10.00			
T-S	0 1900	-18.5 -18.5	0.41 (1)	10.00			
S-R	0 2723	-18.5 -18.5	0.49 (1)	10.00			
R-O	0 2723	-18.5 -18.5	0.49 (1)	10.00			
O-P	0 2723	-18.5 -18.5	0.49 (1)	10.00			
P-O	0 2723	-18.5 -18.5	0.49 (1)	10.00			
O-N	0 1900	-18.5 -18.5	0.41 (1)	10.00			
N-M	0 1801	-18.5 -18.5	0.40 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.0D/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/998 (0.16")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.29")

CSI: TC=0.56/1.00 (E/F:1), BC=0.49/1.00 (O/C:1), WB=0.97/1.00 (J-M:1), SS=0.23/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PLB)
 (P/SI) (PLB)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 788 1987 1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (M) (INPUT = 0.90)

JSI METAL= 0.84 (P) (INPUT = 1.00)




Structural component only
 DWG# T-2007605

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408222	T4	2	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2018 MTek Industries, Inc. Tue Apr 28 09:00:07 2020 Page 1

ID:DMCubiNVR6TsfFoe31v6I_zns11-jLrSn2CZsDQdXWzpsuWGTsbZlqK2C5T4u8iYVWwzMFic
20-8-11 26-7-6 30-9-7 35-2-0 38-5-6
1-3-8 4-4-9 4-2-1 8-6-10 8-0-11 14-7-5 5-11-7 8-0-11 26-7-6 4-2-1 4-4-9 1-3-8
Scale = 1:57.6

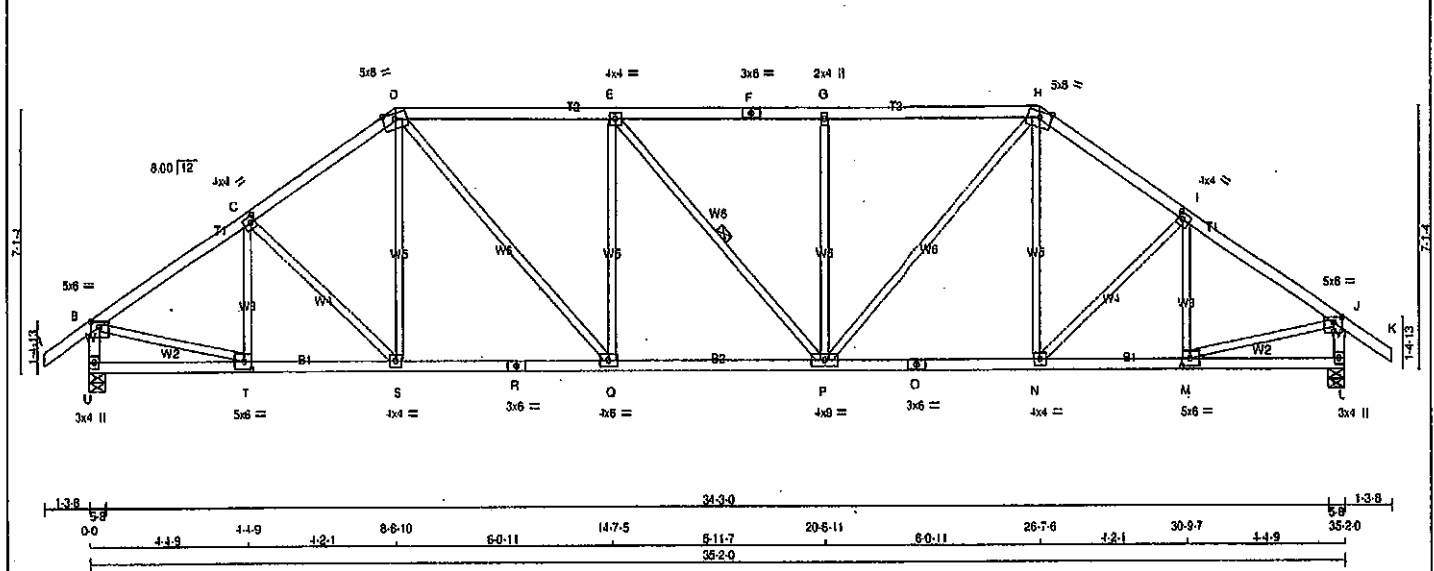

TOTAL WEIGHT = 2 X 155 = 309 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
E - F	2x4	DRY	No.2	SPF	
G - H	2x4	DRY	No.2	SPF	
I - J	2x4	DRY	No.2	SPF	
K - L	2x4	DRY	No.2	SPF	
M - N	2x4	DRY	No.2	SPF	
O - P	2x4	DRY	No.2	SPF	
Q - R	2x4	DRY	No.2	SPF	
S - T	2x4	DRY	No.2	SPF	
U - V	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (tablets in inches)	JT TYPE	PLATES	W	LEN	Y	X
A - B	TMVW-p	MT20	5.0	6.0	1.75	2.75
C - D	TMVW-m	MT20	4.0	4.0	2.00	1.50
E - F	TTVW-m	MT20	5.0	8.0	Edge	
G - H	TMVW-l	MT20	4.0	4.0		
I - J	TS-l	MT20	3.0	6.0		
K - L	TMVW-w	MT20	2.0	4.0		
M - N	TTVW-m	MT20	5.0	8.0	Edge	
O - P	TMVW-l	MT20	4.0	4.0		
Q - R	TMVW-p	MT20	5.0	8.0	1.75	2.75
S - T	BMVW-l	MT20	3.0	4.0		
U - V	BMVW-l	MT20	5.0	8.0	2.50	2.75
W - X	BMVW-l	MT20	4.0	4.0		
Y - Z	BMVW-l	MT20	4.0	9.0		
AA - AB	BMVW-l	MT20	4.0	6.0		
AC - AD	BS-l	MT20	3.0	6.0		
AE - AF	BS-l	MT20	4.0	4.0		
AG - AH	BMVW-l	MT20	5.0	8.0	2.50	2.75
AI - AJ	BMVW-l	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	UPLIFT	IN-SX
U	2065	0	0	5-8
L	2065	0	0	5-8

UNFACTORED REACTIONS

	1ST LCASE	MAX. MIN.	COMPONENT REACTIONS	
	COMBINED	SNOW	LIVE	PERM. LIVE
U	1458	970	0	0
L	1458	970	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FORCE (LBS)	FACTORED CSI (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 35	-91.8	-91.8 0.12 (1)	10.00	T-C	-397 0	0.11 (1)
B-C	-2289 0	-91.8	-91.8 0.37 (1)	4.19	C-S	-78 0	0.05 (1)
C-D	-2254 0	-91.8	-91.8 0.36 (1)	4.21	S-D	0 155	0.04 (4)
D-E	-2485 0	-91.8	-91.8 0.64 (1)	3.72	D-Q	0 949	0.21 (1)
E-F	-2483 0	-91.8	-91.8 0.64 (1)	3.72	Q-E	-597 0	0.52 (1)
F-G	-2483 0	-91.8	-91.8 0.63 (1)	3.72	E-P	-2 0	0.00 (1)
G-H	-2483 0	-91.8	-91.8 0.63 (1)	4.21	P-G	-597 0	0.52 (1)
H-I	-2254 0	-91.8	-91.8 0.36 (1)	4.21	I-H	0 947	0.21 (1)
I-J	-2289 0	-91.8	-91.8 0.37 (1)	4.19	H-N	0 157	0.04 (4)
J-K	0 35	-91.8	-91.8 0.12 (1)	10.00	N-I	-78 0	0.05 (1)
K-L	-2027 0	0.0	0.0 0.21 (1)	5.94	M-I	-397 0	0.11 (1)
L-J	-2026 0	0.0	0.0 0.21 (1)	5.94	B-T	0 1955	0.44 (1)
					M-J	0 1955	0.44 (1)
U-T	0 0	-18.5	-18.5 0.08 (4)	10.00			
T-S	0 1908	-18.5	-18.5 0.37 (1)	10.00			
S-R	0 1853	-18.5	-18.5 0.36 (1)	10.00			
R-Q	0 1853	-18.5	-18.5 0.36 (1)	10.00			
Q-P	0 2485	-18.5	-18.5 0.47 (1)	10.00			
P-O	0 1854	-18.5	-18.5 0.36 (1)	10.00			
O-N	0 1854	-18.5	-18.5 0.36 (1)	10.00			
N-M	0 1908	-18.5	-18.5 0.37 (1)	10.00			
M-L	0 0	-18.5	-18.5 0.08 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

15% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.12')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.24')

CSI: TC=0.64/1.00 (D-E:1), BC=0.47/1.00 (P-Q:1),
WB=0.52/1.00 (E-Q:1), SS=0.26/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (D) INPUT = 0.90
JSI METAL = 0.62 (O) INPUT = 1.00



Structural component only
DWG# T-2007606



PLATES (table in inches)						
JT	PLATE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	6.0	1.75	2.75
C	TMWV-t	MT20	4.0	4.0	2.00	1.50
D	TTWV-m	MT20	5.0	6.0	2.25	1.75
E	TMW-w	MT20	2.0	4.0		
F	TTWV-m	MT20	5.0	8.0	2.25	1.75
G	TMWV-t	MT20	4.0	4.0	2.00	1.50
H	TMWV-p	MT20	5.0	8.0	1.75	2.75
J	BMV-t-p	MT20	3.0	4.0		
K	BMWV-t	MT20	5.0	6.0	2.50	2.75
L	BMWV-t	MT20	4.0	4.0		
M	BS-t	MT20	3.0	6.0		
N	BMWVW-t	MT20	4.0	9.0		
O	BS-t	MT20	3.0	6.0		
P	BMWV-t	MT20	4.0	4.0		
Q	BMWV-t	MT20	5.0	6.0	2.50	2.75
R	BMV-t-p	MT20	3.0	4.0		

TOTAL LOAD CASES: (4)

JSI GRIP = 0.87 (H) (INPUT = 0.80)
JSI METAL = 0.64 (M) (INPUT = 1.00)




JOB NAME 408222	TRUSS NAME T6	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:09 2020 Page 1

ID:OMCubINVR6TstFoe31v6l_zns11-lyCCKEpOrgLmp68ZlykZHqykU0ng01MLSB/apzMFia

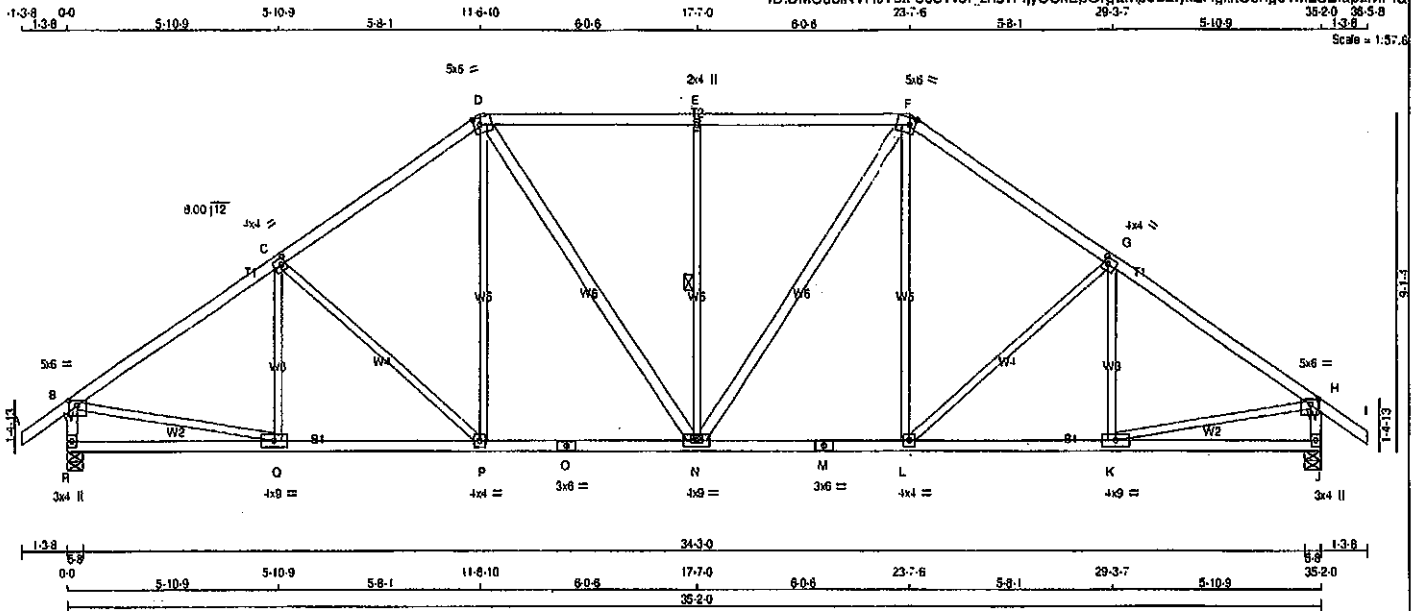

TOTAL WEIGHT = 2 X 165 = 329 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - I	2x4	DRY	No.2	SPF	
R - B	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
R - O	2x4	DRY	No.2	SPF	
O - M	2x4	DRY	No.2	SPF	
M - J	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
D - N	2x4	DRY	No.2	SPF	
N - F	2x4	DRY	No.2	SPF	

DRY, SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		RECORD BRG	
JT	VERT	HORIZ	DOWN	HORIZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
R	2065	0	2065	0	0	5-8	5-8	5-8	5-8
J	2065	0	2065	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST CASE		MAX. MIN. COMPONENT REACTIONS		LIVE		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1458	970	0	0	0	0	0	R	1458	970	0	0	0	0	0
J	1458	970	0	0	0	0	0	J	1458	970	0	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED FORCE		FACTORED VERT. LOAD		LC1 MAX		MAX. UNBRACED LENGTH		WEBS		MAX. FACTORED FORCE		MAX. UNBRACED LENGTH	
MEMB.	FR-TO	FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX	UNBRACED	FR-TO	FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX	UNBRACED	FR-TO	FORCE (LBS)	VERT. LOAD (PLF)
A-B	0 35	-91.8	-91.8	0.12 (1)	10.00	Q-C	-249	11	0.11 (1)						
B-C	-2346	0	-91.8	-91.8	0.52 (1)	3.99	C-P	-356	0	0.42 (1)					
C-D	-2095	0	-91.8	-91.8	0.46 (1)	4.22	P-D	0	0.341	0.08 (1)					
D-E	-1985	0	-91.8	-91.8	0.49 (1)	4.26	D-N	0	0.477	0.08 (1)					
E-F	-1985	0	-91.8	-91.8	0.49 (1)	4.26	N-E	-678	0	0.37 (1)					
F-G	-2095	0	-91.8	-91.8	0.46 (1)	4.22	N-F	0	0.477	0.08 (1)					
G-H	-2346	0	-91.8	-91.8	0.52 (1)	3.99	L-F	0	0.341	0.08 (1)					
H-I	0 35	-91.8	-91.8	0.12 (1)	10.00	L-G	-356	0	0.42 (1)						
R-B	-2018	0	0.0	0.0	0.21 (1)	5.94	K-G	-249	11	0.11 (1)					
J-H	-2018	0	0.0	0.0	0.21 (1)	5.94	B-Q	0	0.201	0.45 (1)					
							K-H	0	0.201	0.45 (1)					
R-Q	0 0	-18.5	-18.5	0.14 (4)	10.00										
Q-P	0 1980	-18.5	-18.5	0.39 (1)	10.00										
P-O	0 1716	-18.5	-18.5	0.34 (1)	10.00										
O-N	0 1716	-18.5	-18.5	0.34 (1)	10.00										
N-M	0 1716	-18.5	-18.5	0.34 (1)	10.00										
M-L	0 1716	-18.5	-18.5	0.34 (1)	10.00										
L-K	0 1981	-18.5	-18.5	0.39 (1)	10.00										
K-J	0 0	-18.5	-18.5	0.14 (4)	10.00										

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L 360 (1.17)
CALCULATED VERT. DEFL.(LL) = L 999 (0.10)
ALLOWABLE DEFL.(TL) = L 360 (1.17)
CALCULATED VERT. DEFL.(TL) = L 999 (0.19)

CSI: TC=0.52:1.00 (G-H:1), BC=0.39:1.00 (K-L:1), WB=0.45:1.00 (H-K:1), SS=0.27:1.00 (O-E:1)

DOL LUMBER=1.00 NAIL=1.00 L5 BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667
		788	1987
		1656	

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (H) INPUT = 0.90
JSI METAL= 0.56 (M) INPUT = 1.00



Structural component only
DWG# T-2007608

JOB NAME 408222	TRUSS NAME T7	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 M&T Industries, Inc. Tue Apr 28 09:00:10 2020 Page 1	
ID:DMCubNVR6TstFoe31vdl_zns1l-7wWp4FR88oCOzhO70Uz5VD4qIMXPTGwa6xC7FzMFIZ					

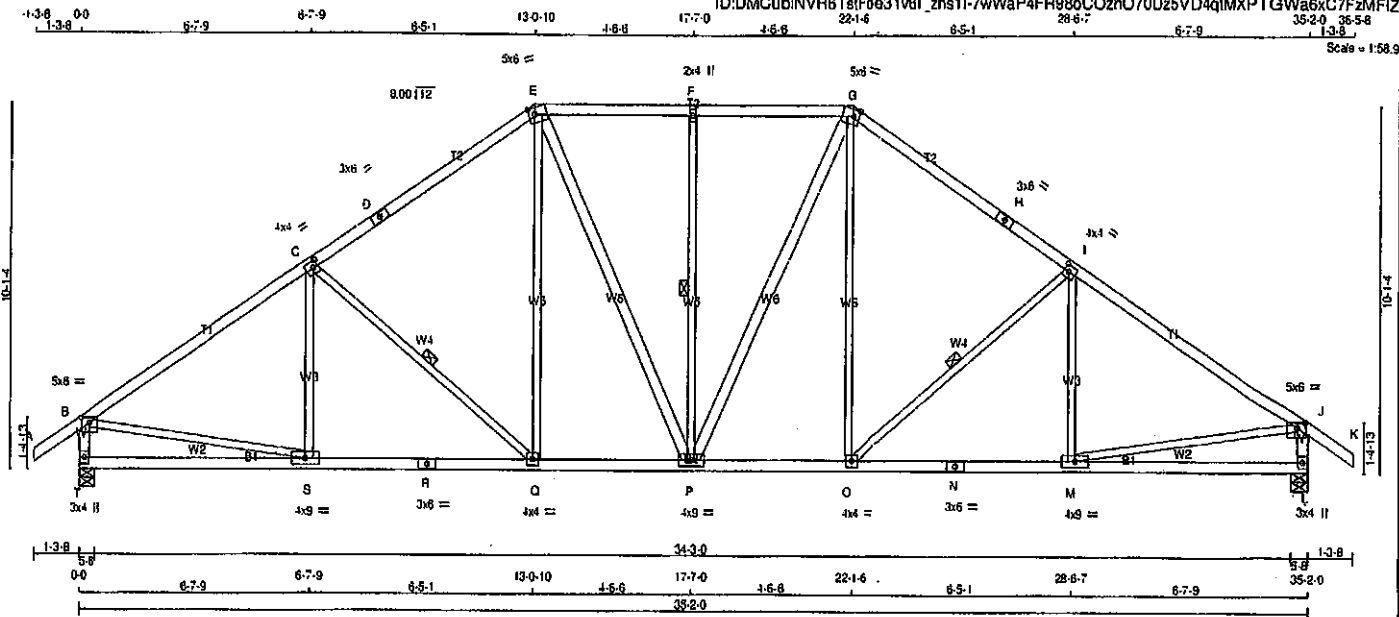

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
T - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
R - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
E - P	2x4	DRY	No.2
P - Q	2x4	DRY	No.2

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW-p	MT20	5.0	6.0 1.75 2.75
C	TMWW-i	MT20	4.0	4.0 2.00 1.50
D	TS-i	MT20	3.0	6.0
E	TTWW-m	MT20	5.0	6.0 2.25 2.00
F	TMW-w	MT20	2.0	4.0
G	TTWW-m	MT20	5.0	6.0 2.25 2.00
H	TS-i	MT20	3.0	6.0
I	TMWW-i	MT20	4.0	4.0 2.00 1.50
J	TMWW-p	MT20	5.0	6.0 1.75 2.75
L	BMV1+p	MT20	3.0	4.0
M	BMWW-i	MT20	4.0	9.0
N	BS-i	MT20	3.0	6.0
O	BMWW-i	MT20	4.0	4.0
P	BMWW-w	MT20	4.0	9.0
Q	BMWW-i	MT20	4.0	4.0
R	BS-i	MT20	3.0	6.0
S	BMWW-i	MT20	4.0	9.0
T	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	BRG	UPLIFT	BRG	IN-SX
T	2065	0	0	2065	0	5-8	0	5-8	0
L	2065	0	0	2065	0	5-8	0	5-8	0

UNFACTORED REACTIONS

JT	COMBINED	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
T	1458	870	0	0	0	0	0	488	0
L	1458	870	0	0	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-O, F-P, I-Q.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	UNBRACED LENGTH (FT)
FR-TO				FR-TO			
A-B	0 35	-91.8	-91.8 0.12 (1)	S-C	-189 46	0.10 (1)	10.00
B-C	-2358 0	-91.8	-91.8 0.69 (1)	C-Q	-484 0	0.24 (1)	3.77
C-D	-1996 0	-91.8	-91.8 0.62 (1)	Q-E	0 415	0.09 (1)	4.11
D-E	-1996 0	-91.8	-91.8 0.62 (1)	E-P	0 315	0.05 (1)	4.11
E-F	-1761 0	-91.8	-91.8 0.27 (1)	P-F	-502 0	0.35 (1)	4.77
F-G	-1761 0	-91.8	-91.8 0.27 (1)	P-G	0 315	0.05 (1)	4.77
G-H	-1996 0	-91.8	-91.8 0.62 (1)	O-G	0 415	0.09 (1)	4.11
H-I	-1996 0	-91.8	-91.8 0.62 (1)	O-I	-484 0	0.24 (1)	4.11
I-J	-2358 0	-91.8	-91.8 0.69 (1)	M-I	-189 46	0.10 (1)	3.77
J-K	0 35	-91.8	-91.8 0.12 (1)	S-S	0 2021	0.45 (1)	10.00
T-B	-2014 0	0.0	0.0 0.21 (1)	S-J	0 2021	0.45 (1)	5.95
L-J	-2014 0	0.0	0.0 0.21 (1)				
T-S	0 0	-18.5	-18.5 0.19 (4)				
S-R	0 1995	-18.5	-18.5 0.42 (1)				
R-Q	0 1995	-18.5	-18.5 0.42 (1)				
Q-P	0 1029	-18.5	-18.5 0.32 (1)				
P-O	0 1029	-18.5	-18.5 0.32 (1)				
O-N	0 1995	-18.5	-18.5 0.42 (1)				
N-M	0 1995	-18.5	-18.5 0.42 (1)				
M-L	0 0	-18.5	-18.5 0.19 (4)				

TOTAL WEIGHT = 6 X 1.72 = 1030 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.18")

CSI: TC=0.69/1.00 (I-J:1), BC=0.42/1.00 (M-O:1), WB=0.45/1.00 (J-M:1), SS=0.24/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP (DRY)	SHEAR SECTION (PSI)	(PLI)	(PLI)
MAX MIN MAX MIN MAX MIN			
MT20	618	354	1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.87 (J) INPUT = 0.90
JSI METAL = 0.67 (N) INPUT = 1.00



Structural component only
DWG# T-2007609

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T9	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:00:11 2020 Page 1
 ID:DMCubINVR6TslFoe31v6l_zns11-b64ydQG4wSx377Gah17CeimKBHhB8z1pmqmfizMF1Y
 1-3-8 0-0 3-9-8 3-9-8 7-4-8 4-10-12 12-3-4 3-9-8 4-10-12 3-10-8 3-10-8 25-10-0 27-1-8
 Scale = 1/4" = 1'-0"

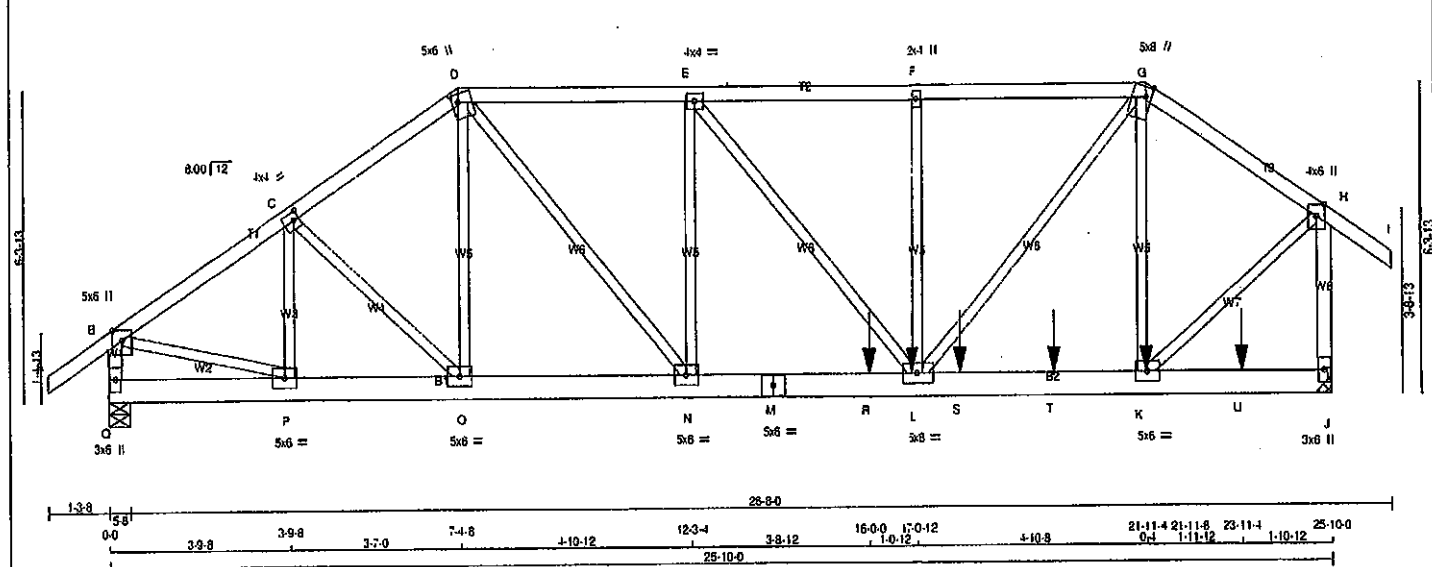

TOTAL WEIGHT = 2 X 136 = 271 lb

LUMBER					DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										DESIGN CRITERIA			
N. L. G. A. RULES					BEARINGS										SPECIFIED LOADS:			
CHORDS		SIZE	LUMBER		DESCR.		FACTORED		MAXIMUM FACTORED		INPUT		REQD		TOP CH. LL = 25.8 PSF			
A - D	2x4	DRY	No.2		SPF		GROSS REACTION		GROSS REACTION		BRG		BRG		DL = 6.0 PSF			
D - G	2x4	DRY	No.2		SPF		JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BOT CH. LL = 0.0 PSF			
G - I	2x4	DRY	No.2		SPF		Q	2238	0	2238	0	0	5-8	5-8	DL = 7.4 PSF			
Q - B	2x4	DRY	No.2		SPF		J	3067	0	3067	0	0	MECHANICAL			TOTAL LOAD = 39.0 PSF		
J - H	2x4	DRY	No.2		SPF		A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 4.0.										SPACING = 24.0 IN/C	
Q - M	2x6	DRY	No.2		SPF												IN/C	
M - J	2x6	DRY	No.2		SPF												IN/C	

UNFACTORED REACTIONS

JT	LOC	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
Q	1575	1065.0	0.0	0.0	0.0	510.0	0.0
J	2157	1479.0	0.0	0.0	0.0	678.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.97 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED CS (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LBS)	
FR-TO		FROM TO		FR-TO			
A-B	0.35	-91.8	-91.8 0.07 (1)	10.00	P-C	-503.0	0.06 (1)
B-C	-2484.0	-91.8	-91.8 0.13 (1)	5.62	C-O	0.70	0.01 (1)
C-D	-2571.0	-91.8	-91.8 0.13 (1)	5.63	O-D	-2.60	0.01 (4)
D-E	-3030.0	-91.8	-91.8 0.20 (1)	5.11	D-N	0.1433	0.18 (1)
E-F	-3235.0	-91.8	-91.8 0.21 (1)	4.97	N-E	-738.0	0.22 (1)
F-G	-3235.0	-91.8	-91.8 0.20 (1)	4.99	E-L	0.327	0.04 (1)
G-H	-2123.0	-91.8	-91.8 0.15 (1)	5.91	L-F	-169.0	0.14 (1)
H-I	0.35	-91.8	-91.8 0.07 (1)	10.00	L-G	0.2339	0.29 (1)
O-B	-2188.0	0.0	0.0 0.12 (1)	7.53	K-G	-995.0	0.30 (1)
J-H	-2962.0	0.0	0.0 0.33 (1)	6.70	B-P	0.2137	0.26 (1)
					K-H	0.2299	0.28 (1)
Q-P	0.0	-18.5	-18.5 0.02 (1)	10.00			
P-O	0.2067	-18.5	-18.5 0.16 (1)	10.00			
O-N	0.2118	-18.5	-18.5 0.22 (1)	10.00			
N-M	0.3030	-18.5	-18.5 0.45 (1)	10.00			
M-R	0.3030	-18.5	-18.5 0.45 (1)	10.00			
R-L	0.3030	-18.5	-18.5 0.45 (1)	10.00			
L-S	0.1746	-18.5	-18.5 0.27 (1)	10.00			
S-T	0.1746	-18.5	-18.5 0.27 (1)	10.00			
T-K	0.1746	-18.5	-18.5 0.27 (1)	10.00			
K-U	0.0	-18.5	-18.5 0.06 (1)	10.00			
U-J	0.0	-18.5	-18.5 0.06 (1)	10.00			


JT	LOC	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
K	21-11-4	-187	-187	---	FRONT	VERT	TOTAL	---
L	16-11-4	-187	-187	---	FRONT	VERT	TOTAL	---
R	16-0-0	-1259	-1259	---	FRONT	VERT	TOTAL	---
S	17-11-4	-187	-187	---	FRONT	VERT	TOTAL	---
T	19-11-4	-187	-187	---	FRONT	VERT	TOTAL	---
U	23-11-4	-195	-195	---	FRONT	VERT	TOTAL	---

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

Structural component only
 DWG# T-2007611 1/2

CONTINUED ON PAGE 2

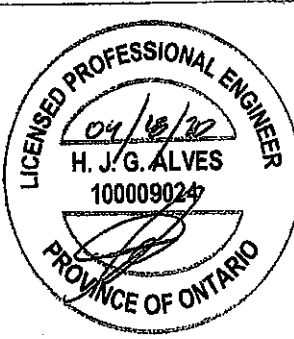

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T9	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 hAtex Industries, Inc. Tue Apr 28 09:00:11 2020 Page 2

ID:DMCubINVR6tsiFoe3tv6l zns1l-b64ydgQ4wSx377Gah?CelmKBHhBBztbmqmizMFY

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	Edge	
C	TMWW-l	MT20	-4.0	4.0	2.00	1.50
D	TTWW+m	MT20	5.0	6.0	2.00	1.50
E	TMWW-l	MT20	-4.0	4.0		
F	TMW+w	MT20	2.0	4.0		
G	TTWW+m	MT20	5.0	8.0	2.50	1.50
H	TMVW+p	MT20	4.0	6.0	Edge	
J	BMV1+p	MT20	3.0	6.0		
K, N, O, P						
K	BMWW-l	MT20	5.0	6.0		
L	BMWWW-l	MT20	5.0	8.0		
M	BS-l	MT20	5.0	6.0		
Q	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.



Structural component only
DWG# T-2007611

Version 8.310 S Oct 29 2019 MoTak Industries, Inc. Tue Apr 28 09:00:12 2020 Page 1

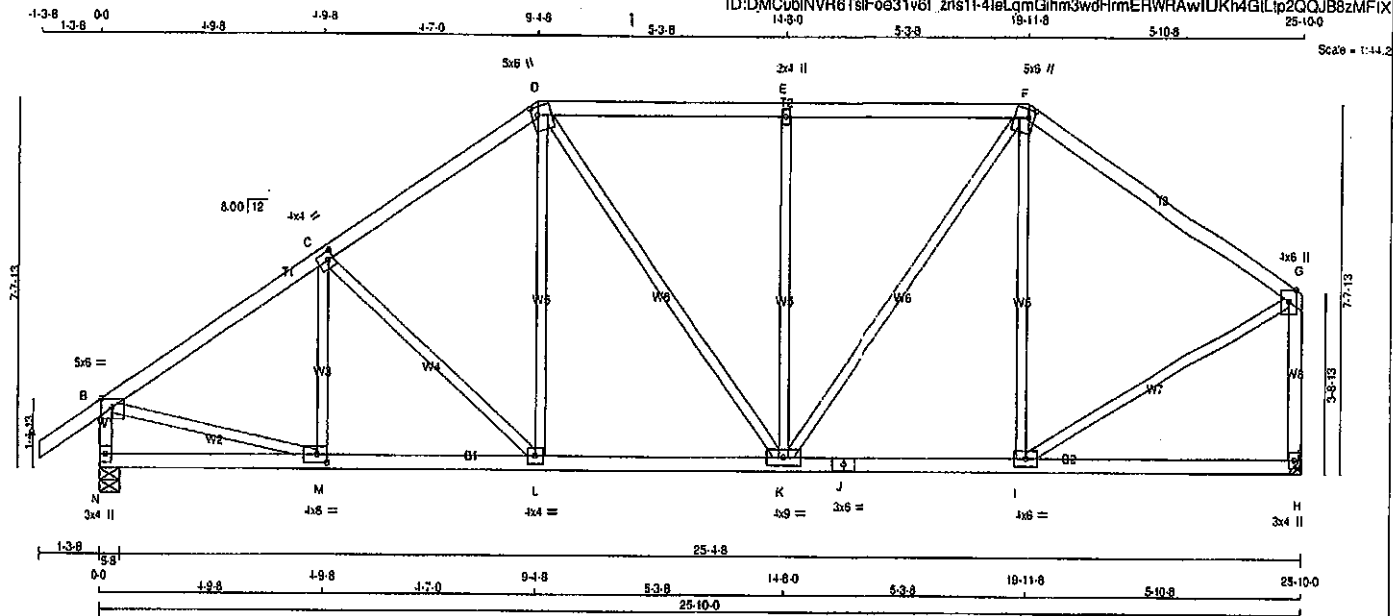

TOTAL WEIGHT = 118 lb

LUMBER			
N. L. G. A. RULES			
CHOICES	SIZE	LUMBER	DESCR
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
N - B	2x4	DRY	No.2
H - G	2x4	DRY	No.2
N - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
J	T	PLATES	W	LEN	Y X
B	TMWV-p	MT20	5.0	6.0	Edge
C	TMWV-l	MT20	4.0	4.0	2.00 1.50
D	TTWV-m	MT20	5.0	6.0	2.00 1.50
E	TMW-w	MT20	2.0	4.0	
F	TTWV-m	MT20	5.0	6.0	2.00 1.50
G	TMWV-p	MT20	4.0	6.0	Edge
H	BWV1-p	MT20	3.0	4.0	
I	BWVW-l	MT20	4.0	6.0	
J	BS-1	MT20	3.0	6.0	
K	BWVWVW-l	MT20	4.0	9.0	
L	BWVW-l	MT20	4.0	4.0	
M	BWVW-l	MT20	4.0	6.0	2.00 2.50
N	BWV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER		FACTORED		MAXIMUM FACTORED		INPUT	RECORD
BEARINGS		GROSS REACTION		GROSS REACTION		BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
N	1580	0	1550	0	0	5-8	5-8
H	1424	0	1424	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3'-8".

UNFACTORED REACTIONS							
1ST CASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
N	1094	731.0	0.0	0.0	0.0	383.0	0.0
H	1007	881.0	0.0	0.0	0.0	348.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.93 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHOROS				WEBB			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 35	-91.8	-91.8 0.12 (1)	10.00	M-C	-217 3	0.07 (1)
B-C	-1609 0	-91.8	-91.8 0.23 (1)	4.82	C-D	-273 0	0.20 (1)
C-D	-1426 0	-91.8	-91.8 0.28 (1)	5.17	D-E	0 280	0.68 (1)
D-E	-1272 0	-91.8	-91.8 0.35 (1)	5.30	E-F	0 185	0.04 (1)
E-F	-1272 0	-91.8	-91.8 0.35 (1)	5.30	K-E	-585 0	0.15 (1)
F-G	-1077 0	-91.8	-91.8 0.43 (1)	5.52	K-F	0 655	0.42 (1)
N-B	-1511 0	0.0	0.0 0.18 (1)	6.68	I-F	-390 0	0.31 (1)
H-G	-1380 0	0.0	0.0 0.32 (1)	6.92	B-M	0 1396	0.23 (1)
					I-G	0 1031	
M-M	0 0	-18.5	-18.5 0.09 (4)	10.00			
N-L	0 1382	-18.5	-18.5 0.27 (1)	10.00			
L-K	0 1164	-18.5	-18.5 0.24 (1)	10.00			
K-J	0 890	-18.5	-18.5 0.23 (1)	10.00			
J-I	0 890	-18.5	-18.5 0.23 (1)	10.00			
I-H	0 0	-18.5	-18.5 0.15 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL =	25.6	PSF
	OL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	OL =	7.4	PSF
TOTAL LOAD =		39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9.
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.86")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.86")
CALCULATED VERT. DEFL.(TL) = L/999 (0.09")

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1 10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)		SHEAR		SECTION
	(PSI)		(PLI)		(PLI)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	618	354	1667	788	1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (B) (INPUT = 0.80)
JSI METAL= 0.56 (G) (INPUT = 1.00)

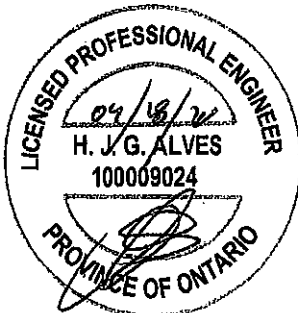


Structural component only
DWG# T-2007612

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T11A	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:00:12 2020 Page 1

ID:DMCubINVR6TstFoe31v6I_zns1I-4feLqmGihm3wdHmERWRAwIXHh2P1N5p2CQJB8zMFIX

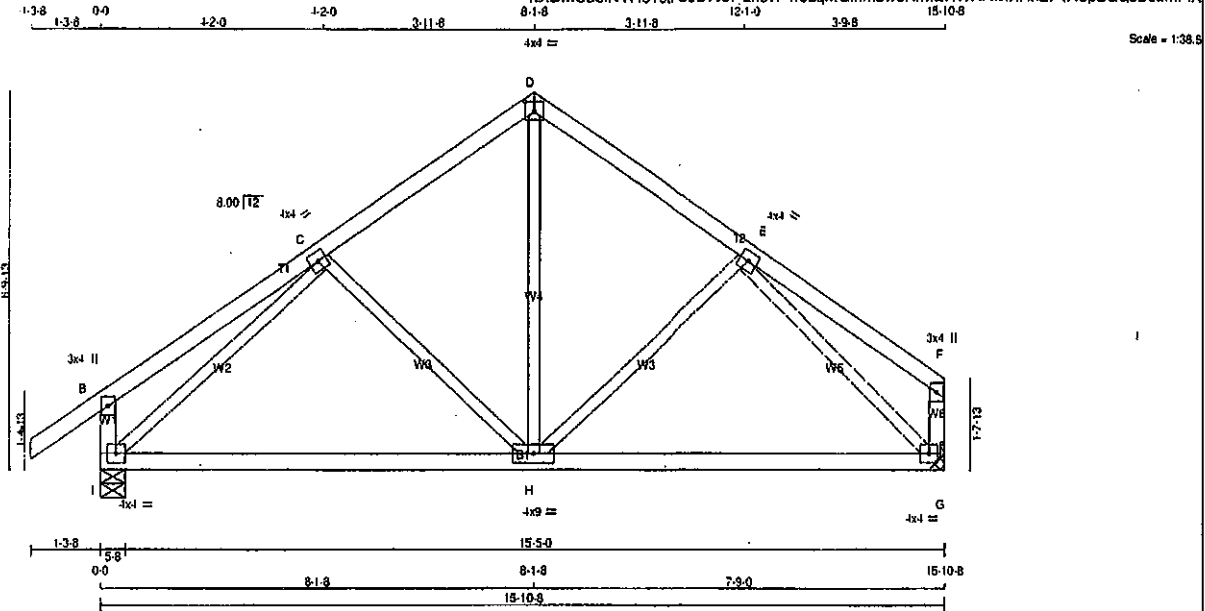

TOTAL WEIGHT = 2 X 66 = 132 lb (M/F)

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
I - B	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
I - G	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV-p	MT20	3.0	4.0		
C TMWV-I	MT20	4.0	4.0		
D TTW-p	MT20	4.0	4.0	2.25	2.00
E TMWV-I	MT20	4.0	4.0		
F TMV-p	MT20	3.0	4.0		
G BMWV-I	MT20	4.0	4.0		
H BMWV-I	MT20	4.0	9.0		
I BMWV-I	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING DESIGNER								
<u>BEARINGS</u>								
	FACTORED		MAXIMUM FACTORED			INPUT		REQD
	GROSS REACTION		GROSS REACTION			BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
I	1001	0	1001	0	0	5-8	5-8	
G	875	0	875	0	0	MECHANICAL		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-6.

UNFACTORED REACTIONS

JT	1ST CASE	2ND CASE	3RD CASE	4TH CASE	5TH CASE	6TH CASE	7TH CASE	8TH CASE
I	708	478	0	0	0	0	228	0
G	619	406	0	0	0	0	213	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. (PLF)	MEMB.	FORCE (LBS)	MAX. (LBS)	MAX. (LBS)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 35	-91.8	-91.8 0.12 (1)	10.00	C-H	-228 0	0.12 (1)
B-C	0 24	-91.8	-91.8 0.24 (1)	10.00	H-D	0 449	0.10 (1)
C-D	-691 0	-91.8	-91.8 0.19 (1)	6.25	H-E	-168 0	0.09 (1)
D-E	-889 0	-91.8	-91.8 0.17 (1)	6.25	I-C	-988 0	0.50 (1)
E-F	0 24	-91.8	-91.8 0.22 (1)	10.00	E-G	-971 0	0.44 (1)
I-B	-269 0	0.0	0.0 0.03 (1)	7.81			
G-F	-125 0	0.0	0.0 0.01 (1)	7.81			
I-H	0 722	-18.5	-18.5 0.39 (4)	10.00			
H-G	0 677	-18.5	-18.5 0.39 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.53")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.53")
CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CSI: TC=0.24/1.00 (B-C:1), BC=0.39/1.00 (H:4), WB=0.50/1.00 (C:1), SS=0.15/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (PSI) SHEAR SECTION (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.84 (E) (INPUT = 0.90)
JSI METAL = 0.35 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007613

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T11B	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Tue Apr 28 10:04:01 2020 Page 1

ID:DMCubINVR6TstFoe31v6L_zns1I-SxVsStcVvDTdV3g25MsNOihBxxWB?PWeSQ4izMEMI

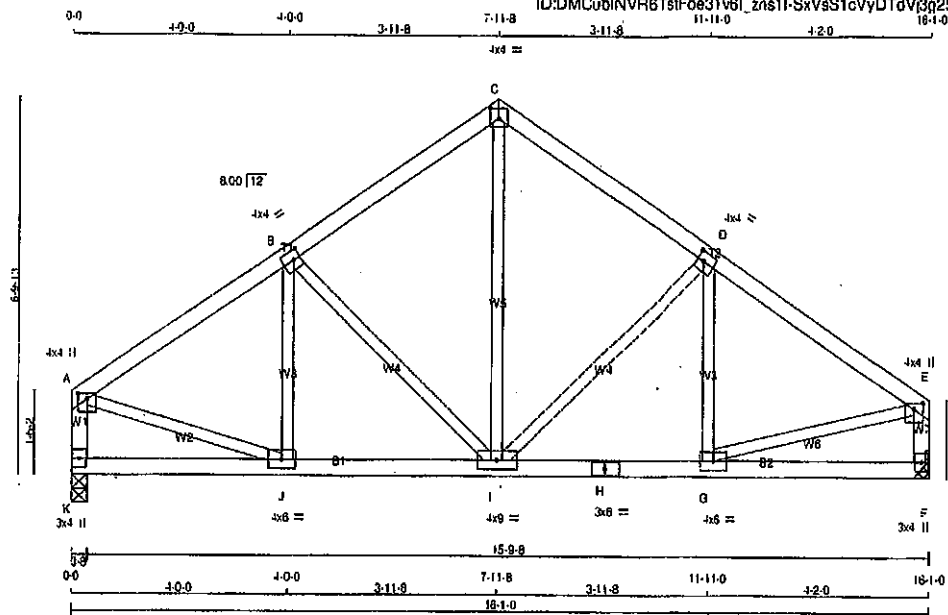

Scale = 1:38.5

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
K - A	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
K - H	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25 2.00
B	TMWW-1	MT20	4.0	4.0	2.00 1.50
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TMWW-1	MT20	4.0	4.0	2.00 1.50
E	TMVW+p	MT20	4.0	4.0	1.25 2.00
F	BMV1+p	MT20	3.0	4.0	
G	BMWW-1	MT20	4.0	6.0	
H	BS-1	MT20	3.0	6.0	
I	BMWW-1	MT20	4.0	9.0	
J	BMWW-1	MT20	4.0	6.0	
K	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORIZ	DOWN	HORIZ
K	887	0	887	0
F	887	0	887	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3'-8".

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	827	411.0	0.0	0.0	0.0	0.0	216.0	0.0
F	827	411.0	0.0	0.0	0.0	0.0	216.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	-888	0	-91.8 -91.8 0.19 (1)	6.25	J-B	-142	18 0.04 (1)
B-C	-687	0	-91.8 -91.8 0.18 (1)	6.25	B-I	-283	0 0.13 (1)
C-D	-688	0	-91.8 -91.8 0.19 (1)	6.25	I-C	0	481 0.10 (1)
D-E	-891	0	-91.8 -91.8 0.20 (1)	6.25	I-D	-292	0 0.15 (1)
K-A	-855	0	0.0 0.0 0.09 (1)	7.61	G-D	-117	28 0.03 (1)
F-E	-853	0	0.0 0.0 0.09 (1)	7.61	A-J	0	772 0.17 (1)
					G-E	0	787 0.18 (1)
K-J	0	0	-18.5 -18.5 0.07 (4)	10.00			
J-I	0	740	-18.5 -18.5 0.15 (1)	10.00			
I-H	0	781	-18.5 -18.5 0.15 (1)	10.00			
H-G	0	761	-18.5 -18.5 0.15 (1)	10.00			
G-F	0	0	-18.5 -18.5 0.07 (4)	10.00			

TOTAL WEIGHT = 2 X 89 = 137 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6	PSF
OL	= 6.0	PSF
BOT CH. LL	= 0.0	PSF
OL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. DIC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD! EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.54")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.54")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSI: TC=0.20/1.00 (D-E:1), BC=0.15/1.00 (G-I:1), WB=0.18/1.00 (E-G:1), SS=0.15/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION	(PSI)	(PLI)	(PLI)
MAX MIN MAX MIN MAX MIN			
MT20	618	354	1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (E) (INPUT = 0.90)
JSI METAL = 0.25 (H) (INPUT = 1.00)



Structural component only
DWG# T-2007631

JOB NAME 408222 Tamarack Roof Truss, Burlington	TRUSS NAME T11S	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---	--------------------	---------------	----------	-------------------------------	-------------	----------

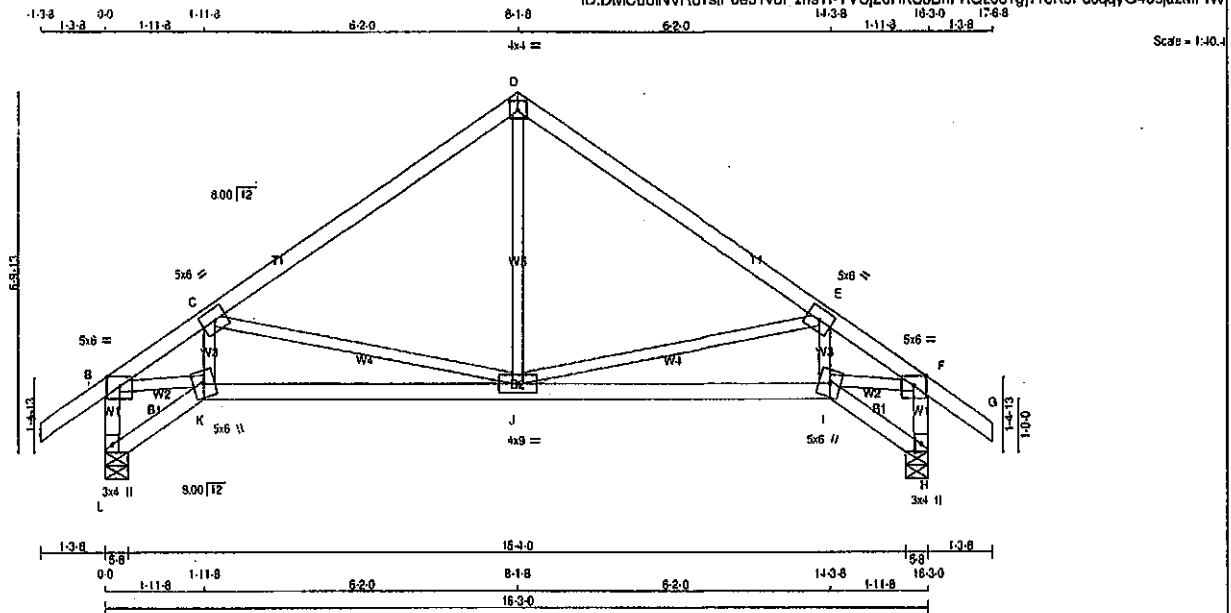

TOTAL WEIGHT = 2 X 67 = 134 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
L - B	2x4	DRY	No.2
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW-p	MT20	5.0	8.0 Edge
C	TMVW-t	MT20	5.0	8.0
D	TTW-p	MT20	4.0	4.0 2.25 2.00
E	TMVW-t	MT20	5.0	6.0
F	TMVW-p	MT20	5.0	6.0 Edge
H	BMV1+p	MT20	3.0	4.0 Edge
I	BBWW+m	MT20	5.0	6.0
J	BMVW-t	MT20	4.0	9.0
K	BBWW+m	MT20	5.0	8.0
L	BMV1+p	MT20	3.0	4.0 Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
FACTORED				MAXIMUM FACTORED		INPUT	
GROSS REACTION				GROSS REACTION		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
L	1022	0	1022	0	0	5-8	5-8
H	1022	0	1022	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST CASE MAX. MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
L	720	488.0	0.0	0.0	0.0	234.0	0.0
H	720	488.0	0.0	0.0	0.0	234.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.97 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. MAX. CSH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. MAX. CSH (LC)	
FR-TO		FROM	TO	FR-TO		FROM	TO
L-B	-1004.0	0.0	0.0 0.11 (1)	7.80	B-K	0 1321	0.30 (1)
A-B	0 35	-91.8	-91.8 0.12 (1)	10.00	K-C	0 55	0.02 (4)
B-C	-1508.0	0.0	-91.8 -91.8 0.33 (1)	4.97	C-J	-859.0	0.46 (1)
C-D	-841.0	0.0	-91.8 -91.8 0.41 (1)	6.08	J-D	0 444	0.10 (1)
D-E	-841.0	0.0	-91.8 -91.8 0.42 (1)	6.07	J-E	-861.0	0.47 (1)
E-F	-1510.0	0.0	-91.8 -91.8 0.33 (1)	4.97	I-E	0 86	0.02 (4)
F-G	0 35	-91.8	-91.8 0.12 (1)	10.00	I-F	0 1323	0.30 (1)
H-F	-1004.0	0.0	0.0 0.11 (1)	7.80			
L-K	0 0	-18.5	-18.5 0.02 (4)	10.00			
K-J	0 1319	-18.5	-18.5 0.33 (1)	10.00			
J-I	0 1320	-18.5	-18.5 0.33 (1)	10.00			
I-H	0 0	-18.5	-18.5 0.02 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L 360 (0.54")
CALCULATED VERT. DEFL.(LL) = L 999 (0.03")
ALLOWABLE DEFL.(TL) = L 360 (0.54")
CALCULATED VERT. DEFL.(TL) = L 999 (0.08")

CSI: TC=0.42/1.00 (D/E:1), BC=0.33/1.00 (I-J:1), WB=0.47/1.00 (E-J:1), SS=0.21/1.00 (D-E:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.89 (I) (INPUT = 0.90)
JSI METAL = 0.47 (K) (INPUT = 1.00)



Structural component only
DWG# T-2007614

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T12S	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 M&E Industries, Inc. Tue Apr 28 09:00:14 2020 Page 1

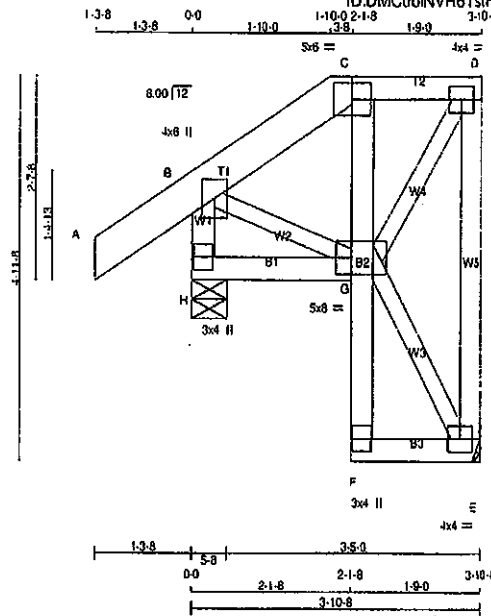

Scale = 1/2" = 1'-0"

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DRY
A - C	2x6	DRY	No.2
C - D	2x4	DRY	No.2
E - D	2x4	DRY	No.2
H - B	2x4	DRY	No.2
H - G	2x4	DRY	No.2
F - C	2x4	DRY	No.2
F - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	6.0	
C	TTV-m	MT20	5.0	6.0	
D	TMVW-l	MT20	4.0	4.0	
E	BMVW-l	MT20	4.0	4.0	
F	BMV+p	MT20	3.0	4.0	
G	BMVWW-l	MT20	5.0	8.0	2.50 2.50
H	BMV-l+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
E	214	0	214	0	0
H	344	0	344	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	151	99	0	0	0	0	0
H	241	172	0	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0 36	G-D	0 139
B-C	-105 0	B-G	0 98
C-D	-79 0	G-E	-3 0
E-D	-196 0		
H-B	-323 0		
H-G	0 0		
F-G	0 17		
G-C	-119 0		
F-E	0 2		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
OL = 6.0 PSF
BOT CH. LL = 0.0 PSF
OL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPC 2011, TPC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.08/1.00 (D/E:1) . BC=0.03/1.00 (G/H:1) .
WB=0.03/1.00 (D/G:1) . SSI=0.07/1.00 (A-B:5)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (D)RY SHEAR SECTION
(PSI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.19 (B) INPUT = 0.90
JSI METAL = 0.11 (B) INPUT = 1.00



Structural component only
DWG# T-2007615


JOB NAME 408223	TRUSS NAME T20	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Tue Apr 28 10:04:02 2020 Page 1

ID:DMCubINVR6Tsf0e31v6I zns11-x73EgNd7XbU6sscoD6Paw0PaBNFZ7YIIB c8zMEMh

1-3-8 0-0 1-10-0 1-12 8-0-8 11-3-2 6-3-14 17-7-0 6-3-14 23-10-14 6-5-2 30-4-0 4-10-0 1-3-8 35-2-0 36-5-8
Scale = 1:57.6

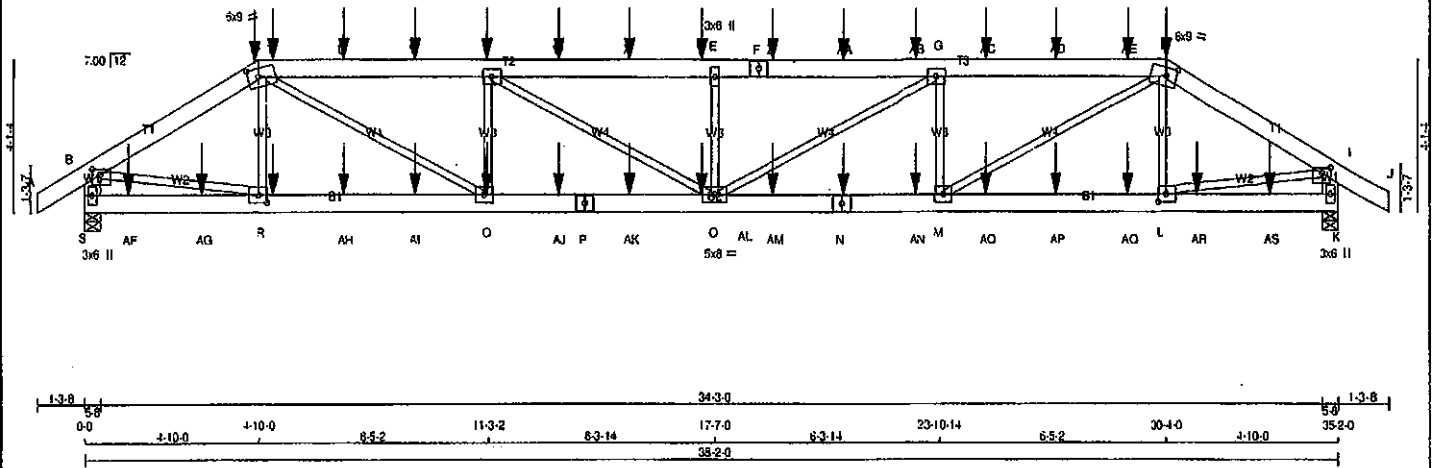

TOTAL WEIGHT = 2 X 180 = 360 lb

CHORDS	SIZE	DRY	NO.2	DESCR.
A - C	2x6	DRY	No.2	SPF
C - F	2x6	DRY	No.2	SPF
F - H	2x6	DRY	No.2	SPF
H - J	2x6	DRY	No.2	SPF
S - B	2x6	DRY	No.2	SPF
K - I	2x6	DRY	No.2	SPF
S - P	2x6	DRY	No.2	SPF
P - N	2x6	DRY	No.2	SPF
N - K	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	2	12
C-F	2	12
F-H	2	12
H-J	2	12
S-B	2	12
K-I	2	12
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S-P	2	12
P-N	2	12
N-K	2	12
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	1	6

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
GROSS REACTION	GROSS REACTION	DOWN	HORIZ	UP/LIFT	IN-SX	IN-SX	BRG
JT	3423	0	0	0	5-8	5-8	
S	3423	0	0	0	5-8	5-8	
K	3365	0	0	0	5-8	5-8	

UNFACTORED REACTIONS

1ST CASE	MAX./MIN. COMPONENT REACTIONS	1ST CASE	MAX./MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
S	2416	1600	0
K	2378	1573	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.03 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 33	-91.8	-91.8 0.04 (1)	10.00	R-C	-431 9	0.05 (1)
B-C	-4681 0	-91.8	-91.8 0.13 (1)	5.23	C-Q	0 3534	0.44 (1)
C-T	-7102 0	-91.8	-91.8 0.31 (1)	4.28	Q-D	-1555 0	0.19 (1)
T-U	-7102 0	-91.8	-91.8 0.31 (1)	4.28	D-O	0 1048	0.13 (1)
U-V	-7102 0	-91.8	-91.8 0.31 (1)	4.28	O-E	-864 0	0.10 (1)
V-D	-7102 0	-91.8	-91.8 0.31 (1)	4.28	O-G	0 1085	0.13 (1)
D-W	-8010 0	-91.8	-91.8 0.32 (1)	4.05	M-G	-1573 0	0.19 (1)
W-X	-8010 0	-91.8	-91.8 0.32 (1)	4.05	M-H	0 3572	0.44 (1)
X-Y	-8010 0	-91.8	-91.8 0.32 (1)	4.05	L-H	-421 10	0.05 (1)
Y-E	-8010 0	-91.8	-91.8 0.32 (1)	4.05	B-R	0 4088	0.51 (1)
E-F	-8010 0	-91.8	-91.8 0.33 (1)	4.03	L-I	0 4022	0.50 (1)
F-Z	-8010 0	-91.8	-91.8 0.33 (1)	4.03			
Z-AA	-8010 0	-91.8	-91.8 0.33 (1)	4.03			
AA-AB	-8010 0	-91.8	-91.8 0.33 (1)	4.03			
AB-G	-8010 0	-91.8	-91.8 0.33 (1)	4.03			
G-AC	-7070 0	-91.8	-91.8 0.30 (1)	4.27			
AC-AD	-7070 0	-91.8	-91.8 0.30 (1)	4.27			
AD-AE	-7070 0	-91.8	-91.8 0.30 (1)	4.27			
AE-H	-7070 0	-91.8	-91.8 0.30 (1)	4.27			
H-I	-4608 0	-91.8	-91.8 0.13 (1)	5.28			
I-J	0 33	-91.8	-91.8 0.04 (1)	10.00			
S-B	-3367 0	0.0	0.0 0.12 (1)	7.58			
K-I	-3318 0	0.0	0.0 0.12 (1)	7.63			

S-AF	0 0	-18.5	-18.5 0.06 (4)	10.00
AF-AG	0 0	-18.5	-18.5 0.06 (4)	10.00
AG-R	0 0	-18.5	-18.5 0.06 (4)	10.00
R-AH	0 4024	-18.5	-18.5 0.31 (1)	10.00
AH-AI	0 4024	-18.5	-18.5 0.31 (1)	10.00
AI-Q	0 4024	-18.5	-18.5 0.31 (1)	10.00
Q-AJ	0 7102	-18.5	-18.5 0.52 (1)	10.00
AJ-P	0 7102	-18.5	-18.5 0.52 (1)	10.00
P-AK	0 7102	-18.5	-18.5 0.52 (1)	10.00
AK-AL	0 7102	-18.5	-18.5 0.52 (1)	10.00
AL-O	0 7102	-18.5	-18.5 0.52 (1)	10.00
O-AM	0 7070	-18.5	-18.5 0.52 (1)	10.00
AM-N	0 7070	-18.5	-18.5 0.52 (1)	10.00
N-AN	0 7070	-18.5	-18.5 0.52 (1)	10.00
AN-M	0 7070	-18.5	-18.5 0.52 (1)	10.00
M-AO	0 3960	-18.5	-18.5 0.30 (1)	10.00
AO-AP	0 3960	-18.5	-18.5 0.30 (1)	10.00
AP-AO	0 3960	-18.5	-18.5 0.30 (1)	10.00
AO-L	0 3960	-18.5	-18.5 0.30 (1)	10.00

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDT. USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.20")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.37")

CSI: TC=0.33(1.00) (E-G:1), BC=0.52(1.00) (O-Q:1), WB=0.51 1.00 (B-R:1), SSI=0.18(1.00) (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1687 788 1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (Q) INPUT = 0.90
JSI METAL = 0.68 (P) INPUT = 1.00



Structural component only
DWG# T-2007632 1/2

CONTINUED ON PAGE 2

JOB NAME 408223	TRUSS NAME T20	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:02 2020 Page 2	
				ID:DMCubINVR6tsIFog31v6l zns11-x73EqNd7IXbU6s8sc0DbPaw0PaBNFZ7YIIB c8zMEMh	

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	2.75
C	TTWW-m	MT20	6.0	9.0	2.75	3.50
D	TMWW-l	MT20	5.0	6.0		
E	TMW+ww	MT20	3.0	6.0		
F	TS-l	MT20	5.0	6.0		
G	TMWW-l	MT20	5.0	6.0		
H	TTWW-m	MT20	6.0	9.0	2.75	3.50
I	TMVW-p	MT20	5.0	6.0	1.75	2.75
K	BMV1+p	MT20	3.0	6.0		
L	BMWW-l	MT20	5.0	6.0	2.50	2.75
M	BMWW-l	MT20	5.0	6.0		
N	BS-l	MT20	5.0	6.0		
O	BMWWWW-l	MT20	5.0	6.0		
P	BS-l	MT20	5.0	6.0		
Q	BMWW-l	MT20	5.0	6.0		
R	BMWW-l	MT20	5.0	6.0	2.50	2.75
S	BMV1+p	MT20	3.0	6.0		

LOADING

TOTAL LOAD CASES: (4)


CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CS1 (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO		LENGTH	FR-TO		
L-AR	0 0		-18.5	-18.5 0.06 (4)	10.00		
AR-AS	0 0		-18.5	-18.5 0.06 (4)	10.00		
AS-K	0 0		-18.5	-18.5 0.06 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-10-0	-80	-67	---	FRONT	VERT	DEAD	---	C1
C	4-10-0	-311	-311	---	FRONT	VERT	SNOW	---	C1
D	11-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	30-4-0	-60	-67	---	FRONT	VERT	DEAD	---	C1
H	30-4-0	-311	-311	---	FRONT	VERT	SNOW	---	C1
N	21-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Q	11-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
R	5-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	5-2-12	-138	-138	---	FRONT	VERT	TOTAL	---	C1
U	7-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	9-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	13-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	15-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	17-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	19-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	21-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	29-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	1-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	3-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	7-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	9-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	13-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	15-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AL	17-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AM	19-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AN	23-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AO	25-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AP	27-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AQ	29-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AR	31-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AS	33-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

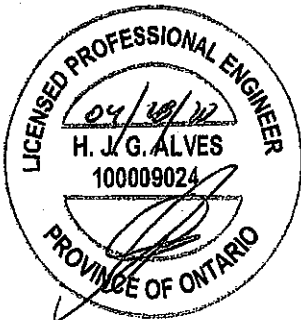


Structural component only
DWG# T-2007632

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408223	T21	1	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Tue Apr 28 10:04:03 2020 Page 1
ID:DMCubINVR6TstFoe31v6l zns11-PKd01eUgJk0D3AWkx0T6J Wk xSI yxX9bzMEMg
35-2-0 35-5-8 1-3-8
Scale = 1:57.6

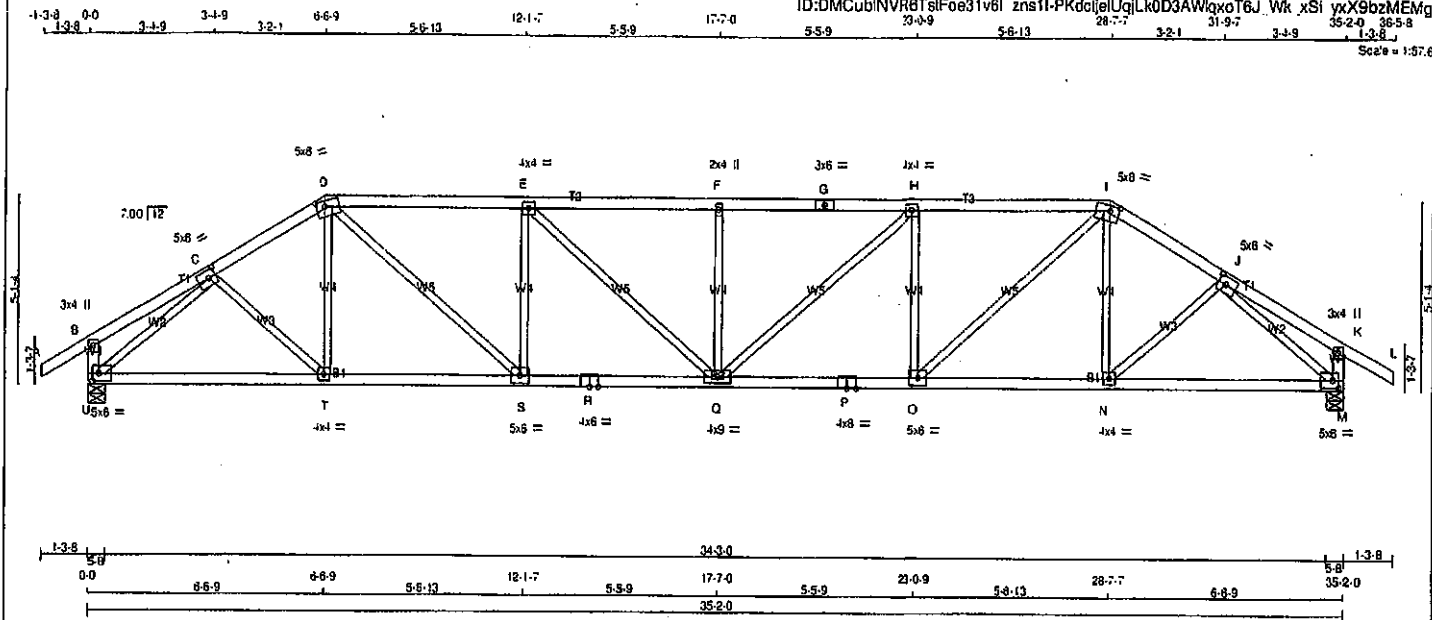

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
U - B	2x4	DRY	No.2
M - K	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - P	2x4	DRY	No.2
P - M	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
C	TMWW-i	MT20	5.0	6.0	2.50 2.50
D	TTWW-m	MT20	5.0	6.0	1.75 3.00
E	TMWW-i	MT20	4.0	4.0	
F	TMWW-w	MT20	2.0	4.0	
G	TS-i	MT20	3.0	6.0	
H	TMWW-i	MT20	4.0	4.0	
I	TTWW-m	MT20	5.0	6.0	1.75 3.00
J	TMWW-i	MT20	5.0	6.0	2.50 2.50
K	TMV+p	MT20	3.0	4.0	
N	BMVW-i	MT20	5.0	6.0	2.50 2.00
O	BMVW-i	MT20	4.0	4.0	
P	BS-i	MT20	4.0	6.0	
Q	BS-i	MT20	4.0	6.0	
R	BS-i	MT20	4.0	6.0	
S	BMVW-i	MT20	5.0	6.0	
T	BMVW-i	MT20	4.0	4.0	
U	BMVW-i	MT20	5.0	6.0	2.50 2.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED	MAXIMUM FACTORED	INPUT	RECORD			
	GROSS REACTION	GROSS REACTION	BRG	BRG			
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
U	2084	0	2064	0	0	5-8	5-8
M	2064	0	2064	0	0	5-8	5-8
UNFACTORED REACTIONS							
1ST CASE	MAX	MIN	COMPONENT	REACTIONS			
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
U	1457	970	0	0	0	488	0
M	1457	970	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.12 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 32	-91.8 -91.8 0.12 (1)	10.00	C-T	0 213	0.05 (1)	
B-C	0 13	-91.8 -91.8 0.12 (1)	10.00	T-D	-8 69	0.02 (4)	
C-D	-2527 0	-91.8 -91.8 0.20 (1)	4.18	D-S	0 1447	0.33 (1)	
D-E	-3264 0	-91.8 -91.8 0.08 (1)	3.30	S-E	-853 0	0.33 (1)	
E-F	-3585 0	-91.8 -91.8 0.70 (1)	3.12	E-Q	0 428	0.10 (1)	
F-G	-3585 0	-91.8 -91.8 0.70 (1)	3.12	Q-F	-482 0	0.18 (1)	
G-H	-3585 0	-91.8 -91.8 0.70 (1)	3.12	Q-H	0 428	0.10 (1)	
H-I	-3264 0	-91.8 -91.8 0.08 (1)	3.30	O-H	-853 0	0.33 (1)	
I-J	-2527 0	-91.8 -91.8 0.20 (1)	4.18	O-I	0 1447	0.33 (1)	
J-K	0 13	-91.8 -91.8 0.12 (1)	10.00	N-I	-8 69	0.02 (4)	
K-L	0 32	-91.8 -91.8 0.12 (1)	10.00	N-J	0 213	0.05 (1)	
U-B	-249 0	0.0 0.0 0.03 (1)	7.81	U-C	-2671 0	0.82 (1)	
M-K	-249 0	0.0 0.0 0.03 (1)	7.81	J-M	-2671 0	0.82 (1)	
U-T	0 2005	-18.5 -18.5 0.42 (1)	10.00				
T-S	0 2167	-18.5 -18.5 0.44 (1)	10.00				
S-R	0 3264	-18.5 -18.5 0.58 (1)	10.00				
R-Q	0 3264	-18.5 -18.5 0.58 (1)	10.00				
Q-P	0 3264	-18.5 -18.5 0.58 (1)	10.00				
P-O	0 3264	-18.5 -18.5 0.58 (1)	10.00				
O-N	0 2167	-18.5 -18.5 0.44 (1)	10.00				
N-M	0 2005	-18.5 -18.5 0.42 (1)	10.00				

TOTAL WEIGHT = 142 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CSI: TC=0.70/1.00 (E-F:1), 8C=0.58/1.00 (Q-S:1), WB=0.82/1.00 (J-M:1), SSI=0.24/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 518 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (M) (INPUT = 0.90)
JSI METAL = 0.74 (R) (INPUT = 1.00)





Structural component only
DWG# T-2007633

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T22	1	1	GREEN PARK HOMES	
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:04 2020 Page 1

ID:DMCubINVR6TstFoe31v6t zns11-1WB743eNF8CMAcF0G3U70GFOITirCcp4h1zMEMI

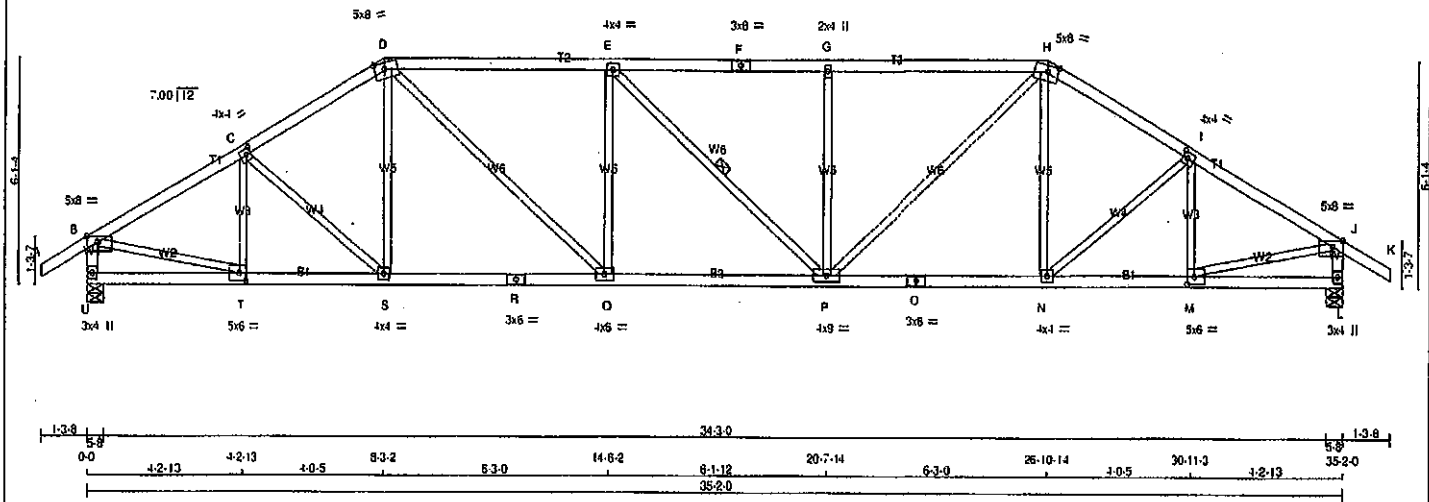

TOTAL WEIGHT = 148 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
U - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMVW-p	MT20	5.0	8.0	Edge 3.50
C TMWW-1	MT20	4.0	4.0	2.00 1.75
D TTWW-m	MT20	5.0	8.0	2.00 3.50
E TMWW-1	MT20	4.0	4.0	
F TS-1	MT20	3.0	8.0	
G TMW-w	MT20	2.0	4.0	
H TTWW-m	MT20	5.0	8.0	2.00 3.50
I TMWW-1	MT20	4.0	4.0	2.00 1.75
J TMVW-p	MT20	5.0	8.0	Edge 3.50
L BMV1-p	MT20	3.0	4.0	
M BMWW-1	MT20	5.0	8.0	2.50 2.50
N BMWW-1	MT20	4.0	4.0	
O BS-1	MT20	3.0	8.0	
P BMWW-1	MT20	4.0	9.0	
Q BMWW-1	MT20	4.0	8.0	
R BS-1	MT20	3.0	8.0	
S BMWW-1	MT20	4.0	4.0	
T BMWW-1	MT20	5.0	8.0	2.50 2.50
U BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BRG
U	2064	0	2064	0	0	0	5.8	5.8	
L	2064	0	2064	0	0	0	5.8	5.8	

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	LIVE	PERM. LIVE	WIND	DEAD	SOIL
U	1457	970 0	0 0	0 0	0 0	488 0	0 0
L	1457	970 0	0 0	0 0	0 0	488 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.37 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADINGS

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. UNBRACED LENGTH (FT)
FR-YO		FROM TO		FR-YO		FROM TO	
A-B	0 32	-91.8 -91.8 0.12 (1)	10.00	T-C	-426 0	0.10 (1)	
B-C	-2468 0	-91.8 -91.8 0.35 (1)	4.07	C-S	-39 0	0.02 (1)	
C-D	-2478 0	-91.8 -91.8 0.34 (1)	4.06	S-D	0 131	0.04 (4)	
D-E	-2910 0	-91.8 -91.8 0.75 (1)	3.37	D-Q	0 1078	0.24 (1)	
E-F	-2909 0	-91.8 -91.8 0.74 (1)	3.38	Q-E	-617 0	0.36 (1)	
F-G	-2909 0	-91.8 -91.8 0.74 (1)	3.38	E-P	-2 0	0.36 (1)	
G-H	-2909 0	-91.8 -91.8 0.75 (1)	3.38	P-G	-617 0	0.36 (1)	
H-I	-2478 0	-91.8 -91.8 0.34 (1)	4.06	P-H	0 1073	0.24 (1)	
I-J	-2468 0	-91.8 -91.8 0.35 (1)	4.07	H-N	0 132	0.04 (4)	
J-K	0 32	-91.8 -91.8 0.12 (1)	10.00	N-I	-39 0	0.02 (1)	
U-B	-2025 0	0.0 0.0 0.21 (1)	5.94	M-I	-426 0	0.10 (1)	
L-J	-2025 0	0.0 0.0 0.21 (1)	5.94	B-T	0 2205	0.50 (1)	
				M-J	0 2205	0.50 (1)	
U-T	0 0	-18.5 -18.5 0.07 (4)	10.00				
T-S	0 2149	-18.5 -18.5 0.41 (1)	10.00				
S-R	0 2122	-18.5 -18.5 0.41 (1)	10.00				
R-Q	0 2122	-18.5 -18.5 0.41 (1)	10.00				
Q-P	0 2910	-18.5 -18.5 0.54 (1)	10.00				
P-O	0 2122	-18.5 -18.5 0.41 (1)	10.00				
O-N	0 2122	-18.5 -18.5 0.41 (1)	10.00				
N-M	0 2149	-18.5 -18.5 0.41 (1)	10.00				
M-L	0 0	-18.5 -18.5 0.07 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 8.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.16")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.30")

CSI: TC=0.75(1.00 (D-E:1)), BC=0.54(1.00 (P-Q:1)), WB=0.50(1.00 (B-T:1)), SSI=0.27(1.00 (D-E:1))

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 616 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.89 (T) INPUT = 0.90
JSI METAL = 0.70 (Q) INPUT = 1.00



Structural component only
DWG# T-2007634

JOB NAME 408223	TRUSS NAME T23	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 28 2019 MTEK Industries, Inc. Tue Apr 28 10:04:06 2020 Page 1
 ID:DMCubINVR8TsiFos31v6I zns11-pwJIVkgeml5w6UyereIXZQ5aqCaVBjG8gw8BvzMEMd
 1-3-8 0-0 5-1-2 5-1-2 4-10-10 9-11-11 7-7-5 17-7-0 7-7-5 25-2-5 4-10-10 30-0-14 5-1-2 1-3-8
 Scale = 1:57.6

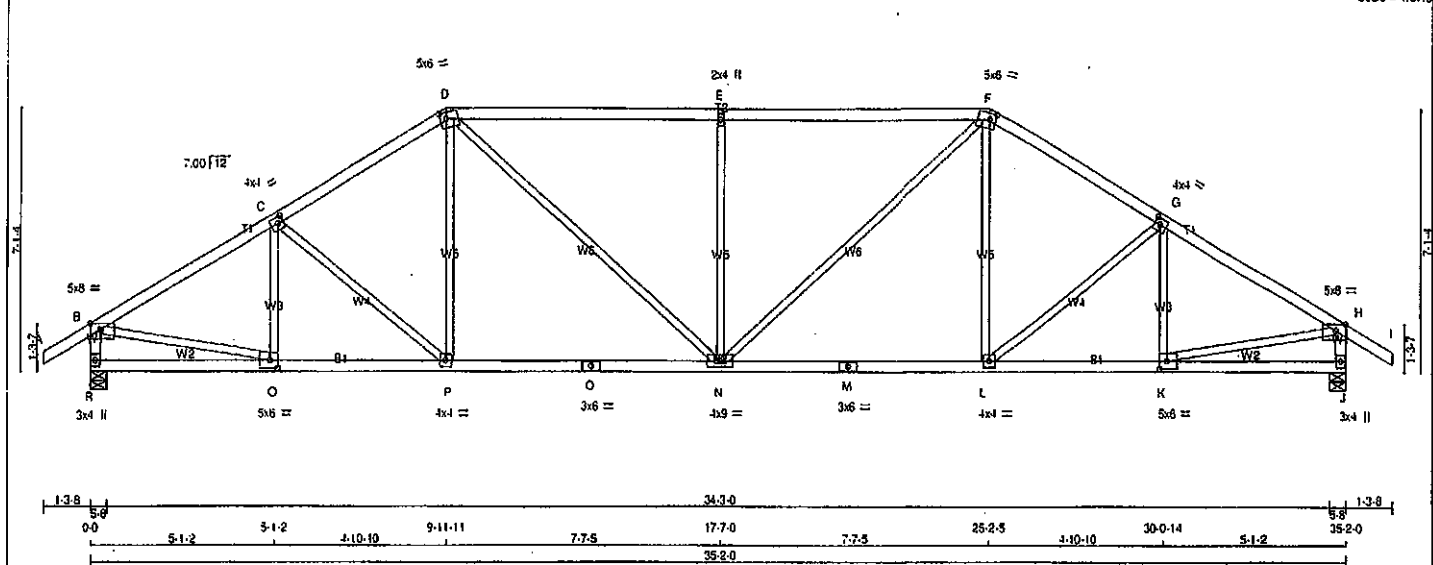

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - I	2x4	DRY No.2	SPF
I - B	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
H - O	2x4	DRY No.2	SPF
O - M	2x4	DRY No.2	SPF
M - J	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW-p	MT20	5.0	8.0 Edge 3.50
C	TMVW-i	MT20	4.0	1.0 2.00 1.75
D	TTWW-m	MT20	5.0	8.0 2.00 2.00
E	TMVW-w	MT20	2.0	4.0
F	TTWW-m	MT20	5.0	8.0 2.00 2.00
G	TMVW-i	MT20	4.0	4.0 2.00 1.75
H	TMVW-p	MT20	5.0	8.0 Edge 3.50
J	BMV1-p	MT20	3.0	4.0
K	BMVW-i	MT20	5.0	6.0 2.50 2.50
L	BMVW-i	MT20	4.0	4.0
M	BS-i	MT20	3.0	6.0
N	BMVW-w	MT20	4.0	9.0
O	BS-i	MT20	3.0	6.0
P	BMVW-i	MT20	4.0	4.0
Q	BMVW-i	MT20	5.0	6.0 2.50 2.50
R	BMV1-p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
R	2084	0	2084	0	5-8
J	2084	0	2084	0	5-8

UNFACTORED REACTIONS		1ST LOSE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1457	970	0	0	0	488	0
J	1457	970	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.16 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		MEMB.	FACTORED	VERT. LOAD	LOI	MAX	MAX.	MEMB.	FACTORED	MAX
FR-TO	MEMB.	FORCE (LBS)	FROM	TO	(PLF)	CSI (LC)	UNBRAC LENGTH	FR-TO	MEMB.	FORCE (LBS)
A-B	0	32	-91.8	-91.8	0.12 (1)	10.00	Q-C	-335	0	0.09 (1)
B-C	-2537	0	-91.8	-91.8	0.39 (1)	4.00	C-P	-216	0	0.16 (1)
C-D	-2398	0	-91.8	-91.8	0.37 (1)	4.11	P-D	0	258	0.06 (4)
D-E	-2609	0	-91.8	-91.8	0.88 (1)	3.18	D-N	0	752	0.17 (1)
E-F	-2609	0	-91.8	-91.8	0.88 (1)	3.18	N-E	-860	0	0.75 (1)
F-G	-2396	0	-91.8	-91.8	0.37 (1)	4.11	N-F	0	752	0.17 (1)
G-H	-2537	0	-91.8	-91.8	0.39 (1)	4.00	L-F	0	258	0.06 (4)
H-I	0	32	-91.8	-91.8	0.12 (1)	10.00	L-G	-216	0	0.16 (1)
R-B	-2020	0	0.0	0.0	0.21 (1)	5.94	K-G	-335	0	0.09 (1)
J-H	-2020	0	0.0	0.0	0.21 (1)	5.94	B-Q	0	2253	0.51 (1)
R-Q	0	0	-18.5	-18.5	0.10 (4)	10.00	K-H	0	2253	0.51 (1)
Q-P	0	2213	-18.5	-18.5	0.45 (1)	10.00				
P-O	0	2048	-18.5	-18.5	0.44 (1)	10.00				
O-N	0	2048	-18.5	-18.5	0.44 (1)	10.00				
N-M	0	2048	-18.5	-18.5	0.44 (1)	10.00				
M-L	0	2048	-18.5	-18.5	0.44 (1)	10.00				
L-K	0	2213	-18.5	-18.5	0.45 (1)	10.00				
K-J	0	0	-18.5	-18.5	0.10 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPC 2011, TPC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.13")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.27")

CSI: TC=0.88(1.00)(E-F:1), BC=0.45(1.00)(K-L:1),
WB=0.75(1.00)(E-N:1), SS=0.34(1.00)(E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.88 (K) (INPUT = 0.90)
JSI METAL= 0.72 (M) (INPUT = 1.00)

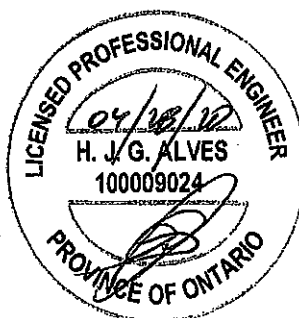

Structural component only
DWG# T-2007635

• **1**

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Tue Apr 28 10:04:07 2020 Page 1
ID:DMCubInVR6TsIfoe3r1v6l_zns11H5s7j4hGX3DnDeWqPLpm6eapobw_wk5HuavkMzMzMEMC
33-5-11 5-8-14 20-2-10 5-11-8 35-2-0 35-8-8
5-10-11 Scale: 1/50

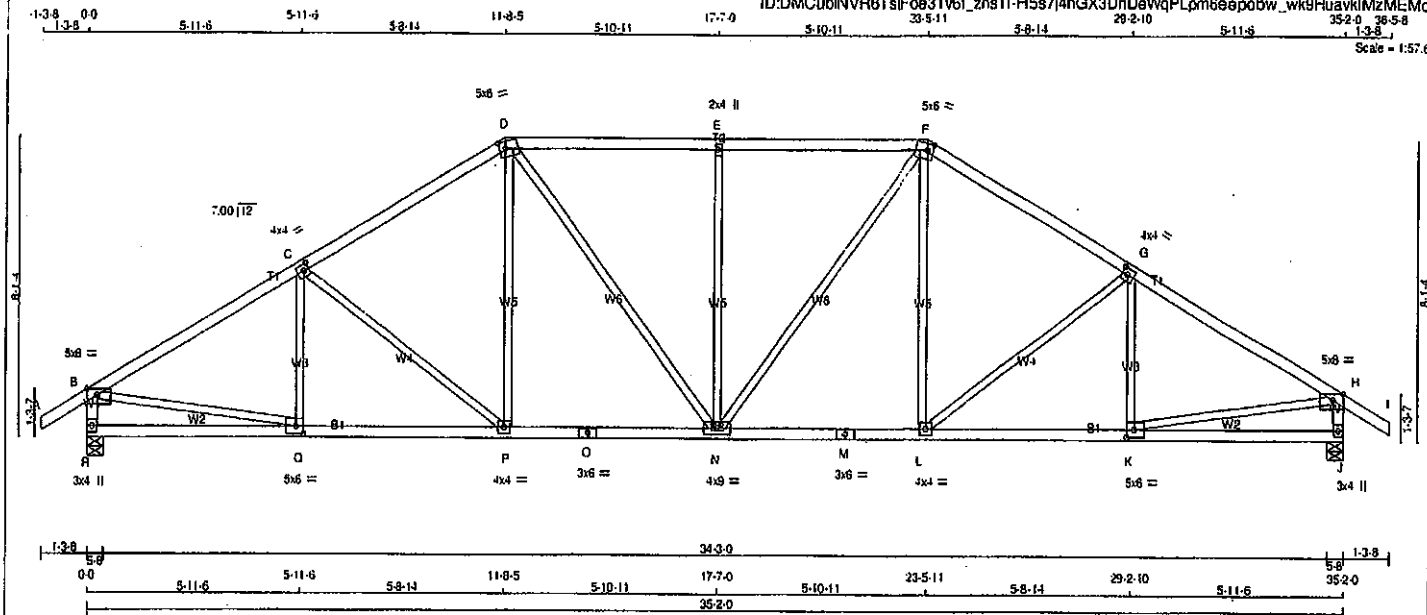

TOTAL WEIGHT = 151 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - I	2x4	DRY No.2	SPF
I - B	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
I - O	2x4	DRY No.2	SPF
O - M	2x4	DRY No.2	SPF
M - J	2x4	DRY No.2	SPF

ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
--------------------	-----	-----	------	-----

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
PLATES	TYPE	PLATES	W	LEN	Y X
B	TMWV-p	MT20	5.0	8.0	Edge 3.50
C	TMWV-I	MT20	4.0	4.0	2.00 1.75
D	TTWV-m	MT20	5.0	6.0	2.25 2.00
E	TMW-v	MT20	2.0	4.0	
F	TTWV-m	MT	5.0	6.0	2.25 2.00
G	TMWV-I	MT20	4.0	4.0	2.00 1.75
H	TMWV-p	MT20	5.0	8.0	Edge 3.50
J	BMV1+p	MT	3.0	4.0	
K	BMWV-I	MT20	5.0	6.0	2.50 2.50
L	BMWV-I	MT20	4.0	4.0	
M	BS-I	MT20	3.0	6.0	
N	BMWVWV-I	MT20	4.0	9.0	
O	BS-I	MT20	3.0	6.0	
P	BMWV-I	MT20	4.0	4.0	
Q	BMWV-I	MT20	5.0	6.0	2.50 2.50
R	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQ'D BRG
JT	VERT	DOWN	HORIZ	IN-SX	IN-SX
R	2084	0	2084	0	5-8
J	2084	0	2084	0	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1457	970 0	0 0	0 0	0 0	488 0	0 0
J	1457	970 0	0 0	0 0	0 0	488 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R. J.

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.81 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM-TO		LENGTH	FR-TO		
A-B	0 32	-91.8	-91.8	0.12 (1)	10.00	Q-C	-252 12 0.08 (1)
B-C	-2275 0	-91.8	-91.8	0.54 (1)	3.81	C-P	-388 0 0.41 (1)
C-D	-2523 0	-91.8	-91.8	0.50 (1)	4.05	P-D	0 345 0.08 (1)
D-E	-2236 0	-91.8	-91.8	0.49 (1)	4.08	D-N	0 480 0.11 (1)
E-F	-2236 0	-91.8	-91.8	0.49 (1)	4.08	N-E	-652 0 0.84 (1)
F-G	-2236 0	-91.8	-91.8	0.50 (1)	4.08	N-F	0 480 0.11 (1)
G-H	-2575 0	-91.8	-91.8	0.54 (1)	3.81	L-F	0 345 0.08 (1)
H-I	0 32	-91.8	-91.8	0.12 (1)	10.00	L-G	-386 0 0.41 (1)
I-B	-2016 0	0.0	0.0	0.21 (1)	5.94	K-G	-252 12 0.08 (1)
J-H	-2016 0	0.0	0.0	0.21 (1)	5.94	B-Q	0 2281 0.51 (1)
						K-H	0 2281 0.51 (1)
R-Q	0 0	-18.5	-18.5	0.14 (4)	10.00		
Q-P	0 2251	-18.5	-18.5	0.43 (1)	10.00		
P-Q	0 1947	-18.5	-18.5	0.38 (1)	10.00		
Q-N	0 1947	-18.5	-18.5	0.38 (1)	10.00		
N-M	0 1947	-18.5	-18.5	0.38 (1)	10.00		
M-L	0 1947	-18.5	-18.5	0.38 (1)	10.00		
L-K	0 2251	-18.5	-18.5	0.43 (1)	10.00		
K-J	0 0	-18.5	-18.5	0.14 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	OL =	8.0	PSF
BOT CH.	LL =	0.0	PSF
	OL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9.
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF
LIVE LOAD

ALLOWABLE DEFL.(LL) = L 360 (1.17")
CALCULATED VERT. DEFL.(LL) = L 999 (0.12")
ALLOWABLE DEFL.(TL) = L 360 (1.17")
CALCULATED VERT. DEFL.(TL) = L 999 (0.22")

CSI: TC=0.54/1.00 (B-C:1) , BC=0.43/1.00 (P-Q:1) ,
WB=0.84/1.00 (E-N:1) , SSI=0.26/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1867	788	1987	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.86 (Q) (INPUT = 0.90)
JSI METAL = 0.81 (M) (INPUT = 1.00)



Structural component only
DWG# T-2007636




JSI GRIP= 0.85 (S) INPUT = 0.90 ;
JSI METAL= 0.89 (N) INPUT = 1.00 ;



JOB NAME 408223	TRUSS NAME IT25A	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Tue Apr 28 10:04:09 2020 Page 1
ID:DMCubINVR6TgFoa31v6I zns11-OU u8miW3gUUSXgCWmsEB3j8iPbBOjwaMiOMeZMEMa
34-10-0

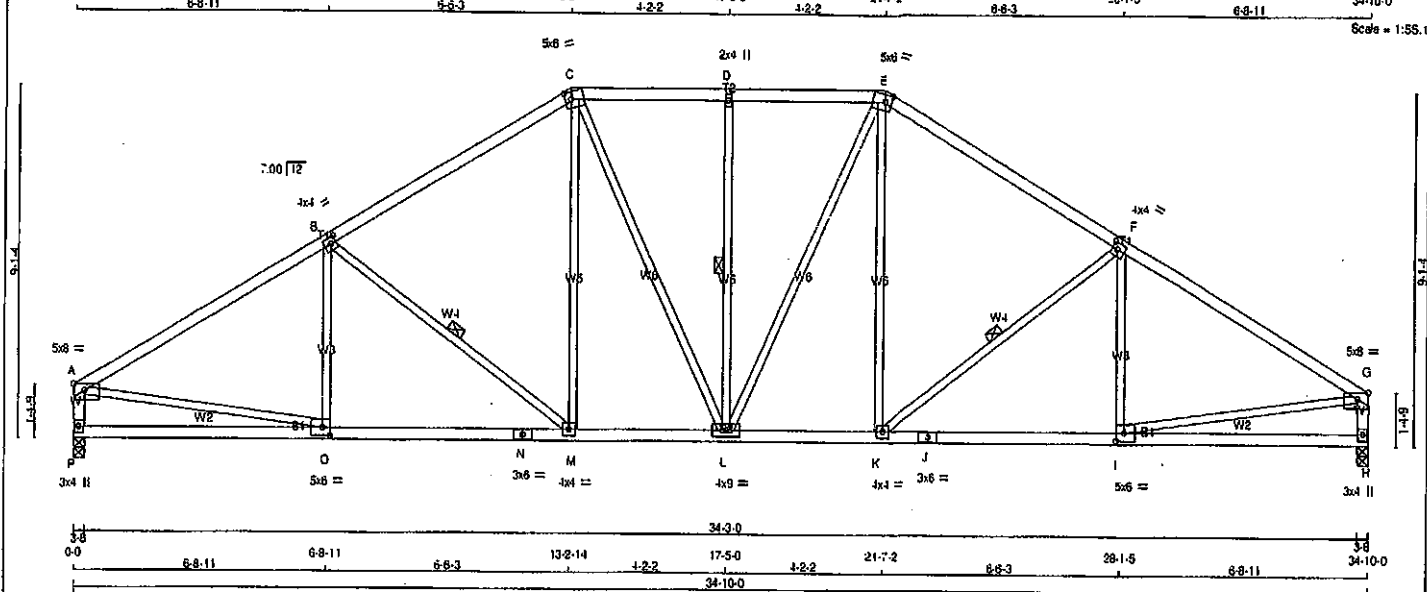

TOTAL WEIGHT = 3 X 154 = 462 lb (M/F)

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	FACTORED	GROSS REACTION	MAXIMUM FACTORED	INPUT	REQD	SPECIFIED LOADS:	
A - C	2x4	DRY	No.2	SPF	VERT	HORZ	DOWN	HORZ	UPLIFT	TOP CH. LL = 25.8 PSF	
C - E	2x4	DRY	No.2	SPF						DL = 6.0 PSF	
E - G	2x4	DRY	No.2	SPF						BOT CH. LL = 0.0 PSF	
G - A	2x4	DRY	No.2	SPF						DL = 7.4 PSF	
H - G	2x4	DRY	No.2	SPF						TOTAL LOAD = 39.0 PSF	
P - N	2x4	DRY	No.2	SPF							
N - J	2x4	DRY	No.2	SPF							
J - H	2x4	DRY	No.2	SPF							

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT
DRY: SEASONED LUMBER.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.64 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF B-M, D-L, F-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO				FR-TO			
A-B	-2510 0	-91.8 -91.8 0.71 (1)	3.64	O-B	-212 40	0.09 (1)	
B-C	-2113 0	-91.8 -91.8 0.63 (1)	3.99	B-M	-510 0	0.24 (1)	
C-D	-1919 0	-91.8 -91.8 0.24 (1)	4.64	M-C	0 412	0.09 (1)	
D-E	-1919 0	-91.8 -91.8 0.24 (1)	4.64	C-L	0 287	0.06 (1)	
E-F	-2113 0	-91.8 -91.8 0.63 (1)	3.99	L-D	-481 0	0.25 (1)	
F-G	-2510 0	-91.8 -91.8 0.71 (1)	3.64	L-E	0 287	0.06 (1)	
P-A	-1888 0	0.0 0.0 0.19 (1)	6.13	K-E	0 412	0.09 (1)	
H-G	-1888 0	0.0 0.0 0.19 (1)	6.13	K-F	-510 0	0.24 (1)	
				I-F	-212 40	0.09 (1)	
P-O	0 0	-18.5 -18.5 0.20 (4)	10.00	A-O	0 2227	0.50 (1)	
O-N	0 2189	-18.5 -18.5 0.45 (1)	10.00	I-G	0 2227	0.50 (1)	
N-M	0 2189	-18.5 -18.5 0.45 (1)	10.00				
M-L	0 1797	-18.5 -18.5 0.35 (1)	10.00				
L-K	0 1797	-18.5 -18.5 0.35 (1)	10.00				
K-J	0 2189	-18.5 -18.5 0.45 (1)	10.00				
J-I	0 2189	-18.5 -18.5 0.45 (1)	10.00				
I-H	0 0	-18.5 -18.5 0.20 (4)	10.00				

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DESIGN CRITERIA

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:


55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/380 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.21")

CS1: TC=0.71 1.00 (A-S:1), BC=0.45 1.00 (M-O:1), WB=0.50 1.00 (A-O:1), SS1=0.26 1.00 (A-S:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10
COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

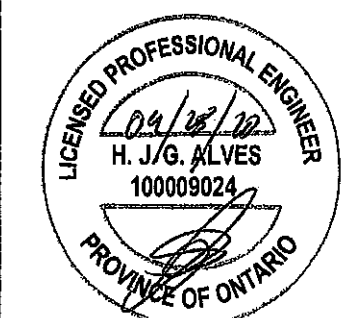


Structural component only
DWG# T-2007638

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T28	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:04:10 2020 Page 1
ID:DMCubiNVR6TsiFoe31v6l zns1l-lqYGL6j8q cl45FP4UNTkGGKpt777 kbX7PuhzMEMZ

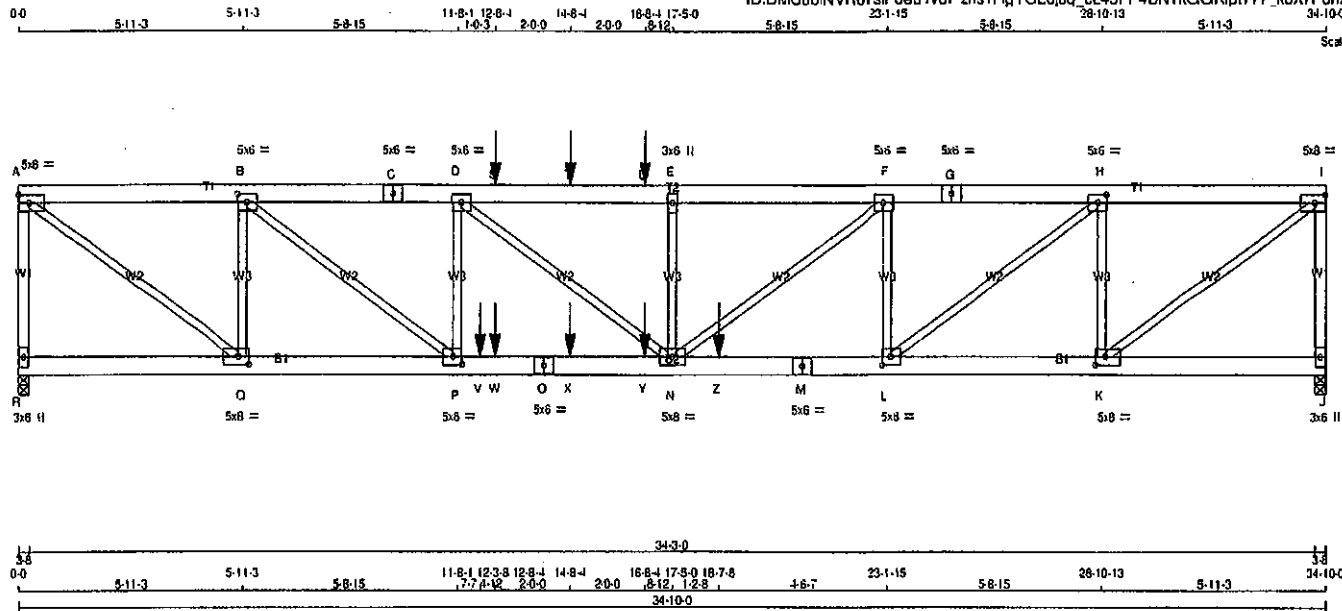

TOTAL WEIGHT = 2 X 183 = 366 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
R - A	2x4	DRY	No.2	SPF		
A - C	2x6	DRY	No.2	SPF		
C - G	2x6	DRY	No.2	SPF		
G - I	2x6	DRY	No.2	SPF		
J - I	2x4	DRY	No.2	SPF		
R - O	2x4	DRY	No.2	SPF		
O - M	2x6	DRY	No.2	SPF		
M - J	2x6	DRY	No.2	SPF		

ALL WEBS 2x3 DRY
DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122'X3") SPIRAL NAILS		
R - A	12	TOP
I - J	12	TOP
A - C	12	TOP
C - G	12	SIDE (0.0)
G - I	12	TOP
BOTTOM CHORDS : (0.122'X3") SPIRAL NAILS		
R - O	12	SIDE (0.0)
O - M	12	SIDE (0.0)
M - J	12	TOP
WEBS : (0.122'X3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG	
JT VERT	3373	0	3373	0
R VERT	3103	0	3103	0

UNFACTORED REACTIONS

1ST CASE	MAX/MIN COMPONENT REACTIONS							
JT COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
R	2330	1591	0	0	0	789	0	0
J	2190	1459	0	0	0	731	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.03 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD LC1	MAX	MAX.	WEBS	MAX. FACTORED	MAX
MEMB.	FORCE (LBS)	VERT. (PLF)	CS1 (LC)	UNBRAC	LENGTH	MEMB.	FORCE (LBS)	MAX CS1 (LC)
FR-TO						FR-TO		
R-A	-3316	0	0.0	0.0	0.58 (1)	K-I	0	4719
A-B	-4149	0	-91.8	-91.8	0.14 (1)	A-Q	0	5171
B-C	-7288	0	-91.8	-91.8	0.20 (1)	K-H	-2757	0
C-D	-7288	0	-91.8	-91.8	0.20 (1)	Q-B	-2997	0
D-S	-8278	0	-91.8	-91.8	0.28 (1)	L-H	0	3530
S-T	-8278	0	-91.8	-91.8	0.28 (1)	B-P	0	3958
T-U	-8278	0	-91.8	-91.8	0.21 (1)	L-F	-1791	0
U-E	-8278	0	-91.8	-91.8	0.28 (1)	P-D	-1403	0
E-F	-8278	0	-91.8	-91.8	0.21 (1)	N-F	0	2134
F-G	-6586	0	-91.8	-91.8	0.19 (1)	D-N	0	1249
G-H	-6586	0	-91.8	-91.8	0.19 (1)	N-E	-673	0
H-I	-3787	0	-91.8	-91.8	0.13 (1)			
I-J	-3042	0	0.0	0.0	0.51 (1)			

R-O	0	0	-18.5	-18.5	0.04 (4)	10.00
Q-P	0	-4149	-18.5	-18.5	0.30 (1)	10.00
P-V	0	7288	-18.5	-18.5	0.87 (1)	10.00
V-W	0	7288	-18.5	-18.5	0.87 (1)	10.00
W-O	0	7288	-18.5	-18.5	0.87 (1)	10.00
O-X	0	7288	-18.5	-18.5	0.87 (1)	10.00
X-Y	0	7288	-18.5	-18.5	0.87 (1)	10.00
Y-N	0	7288	-18.5	-18.5	0.87 (1)	10.00
N-Z	0	5580	-18.5	-18.5	0.72 (1)	10.00
Z-M	0	6586	-18.5	-18.5	0.72 (1)	10.00
M-L	0	6586	-18.5	-18.5	0.72 (1)	10.00
L-K	0	3787	-18.5	-18.5	0.32 (1)	10.00
K-J	0	0	-18.5	-18.5	0.04 (4)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC	LC1	MAX	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
S	12-8-4	-86	-86	---	BACK	VERT	TOTAL	---	C1
T	14-8-4	-86	-86	---	BACK	VERT	TOTAL	---	C1
U	16-8-4	-86	-86	---	BACK	VERT	TOTAL	---	C1
V	12-3-8	-1052	-1052	---	BACK	VERT	TOTAL	---	C1
W	12-8-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
X	14-8-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
Y	16-8-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
Z	18-7-8	-1273	-1273	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CS1: TC=0.56(1.00 (A/R:1)), BC=0.72(1.00 (L/N:1)), WB=0.64(1.00 (A/Q:1)), SS1=0.37(1.00 (L/N:1))

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLB)
MAX MIN MAX MIN MAX MIN
MT20 518 354 1687 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.69 (1) (INPUT = 0.90)
JSI METAL = 0.73 (1) (INPUT = 1.00)



Structural component only
DWG# T-2007639 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T28	1	2	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:04:10 2020 Page 2


ID:DMCubINVR6TstFoe31v6I zns11-iqYGL68q cL45FP4UNTkGKip1777 kbX7PuhzMEMZ

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWW-I	MT20	5.0	8.0	2.50	3.25
B	TMWW-I	MT20	5.0	6.0	2.50	2.75
C	TS-I	MT20	5.0	6.0		
D	TMWW-I	MT20	5.0	6.0		
E	TMWW-I	MT20	5.0	6.0		
F	TMWW-I	MT20	5.0	6.0		
G	TS-I	MT20	5.0	6.0		
H	TMWW-I	MT20	5.0	6.0	2.50	2.75
I	TMWW-I	MT20	5.0	6.0	2.50	3.25
J	BMVI+p	MT20	3.0	6.0		
K	BMWW-I	MT20	5.0	6.0	2.50	3.25
L	BMWW-I	MT20	5.0	6.0	2.50	2.75
M	BS-I	MT20	5.0	6.0		
N	BMWW-I	MT20	5.0	6.0		
O	BS-I	MT20	5.0	6.0		
P	BMWW-I	MT20	5.0	6.0	2.50	2.75
Q	BMWW-I	MT20	5.0	6.0	2.50	3.25
R	BMVI+p	MT20	3.0	6.0		

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

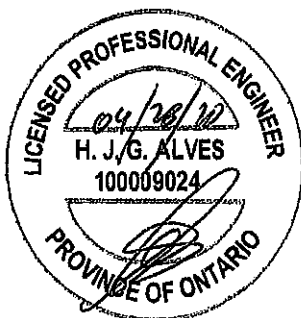


Structural component only
DWG# T-2007639 4/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T29	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:11 2020 Page 1
ID:DMCubINVR6TstFoe31v6I zns1t-As6eYSkmbkCfFqbeBuiGUoUPDIjsbAtpByR7zMEMY

0-0 5-10-8 5-10-8 5-9-1 11-7-12 5-9-1 17-5-0 5-9-1 23-2-4 5-9-1 28-11-8 5-10-8 34-10-0
Scale = 1:54.8

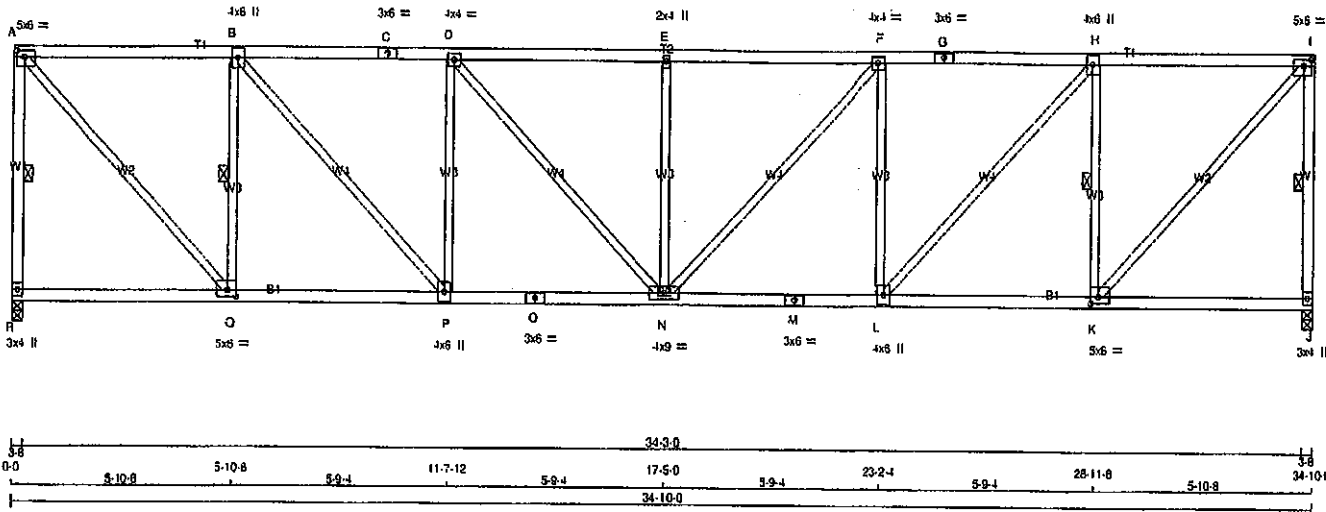

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
R - A	2x4 DRY	No.2			SPF
A - C	2x4 DRY	No.2			SPF
C - G	2x4 DRY	No.2			SPF
G - I	2x4 DRY	No.2			SPF
J - I	2x4 DRY	No.2			SPF
R - O	2x4 DRY	No.2			SPF
O - M	2x4 DRY	No.2			SPF
M - J	2x4 DRY	No.2			SPF
ALL WEBS	2x3 DRY	No.2			SPF
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-I	MT20	5.0	6.0	2.00	2.50
B	TMVW-I	MT20	4.0	6.0		
C	TS-I	MT20	3.0	6.0		
D	TMVW-I	MT20	4.0	4.0		
E	TMVW-I	MT20	2.0	4.0		
F	TMVW-I	MT20	4.0	4.0		
G	TS-I	MT20	3.0	6.0		
H	TMVW-I	MT20	4.0	6.0		
I	TMVW-I	MT20	5.0	6.0	2.00	2.50
J	BMV1-p	MT20	3.0	4.0		
K	BMVW-I	MT20	5.0	6.0	2.00	2.50
L	BMVW-I	MT20	4.0	6.0		
M	BS-I	MT20	3.0	6.0		
N	BMVW-I	MT20	4.0	9.0		
O	BS-I	MT20	3.0	6.0		
P	BMVW-I	MT20	4.0	6.0		
Q	BMVW-I	MT20	5.0	6.0	2.00	2.50
R	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UPLIFT	IN-SX
R	1920	0	0	3-8
J	1920	0	0	3-8

UNFACTORED REACTIONS							
	1ST LCASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1358	891 0	0 0	0 0	0 0	467 0	0 0
J	1358	891 0	0 0	0 0	0 0	467 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-R, I-J, 8-Q, N-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO	LENGTH	FR-TO		
R-A	-1876	0.0	0.0 0.37 (1)	A-Q	0 2281	0.51 (1)
A-B	-1583	-91.8	-91.8 0.53 (1)	Q-B	-1540	0.43 (1)
B-C	-2426	-91.8	-91.8 0.63 (1)	B-P	0 1272	0.29 (1)
C-D	-2426	-91.8	-91.8 0.63 (1)	P-D	-831	0.58 (1)
D-E	-2725	-91.8	-91.8 0.58 (1)	D-N	0 440	0.10 (1)
E-F	-2725	-91.8	-91.8 0.58 (1)	N-E	-539	0.38 (1)
F-G	-2426	-91.8	-91.8 0.63 (1)	G-N	0 440	0.10 (1)
G-H	-2426	-91.8	-91.8 0.63 (1)	N-F	-831	0.58 (1)
H-I	-1563	-91.8	-91.8 0.53 (1)	L-H	0 1272	0.29 (1)
I-J	-1876	0.0	0.0 0.37 (1)	K-H	-1540	0.43 (1)
				K-I	0 2281	0.51 (1)
P-Q	0 0	-18.5	-18.5 0.15 (4)			
Q-P	0 1583	-18.5	-18.5 0.35 (1)			
P-O	0 2426	-18.5	-18.5 0.44 (1)			
O-N	0 2426	-18.5	-18.5 0.44 (1)			
N-M	0 2426	-18.5	-18.5 0.44 (1)			
M-L	0 2426	-18.5	-18.5 0.44 (1)			
L-K	0 1583	-18.5	-18.5 0.33 (1)			
K-J	0 0	-18.5	-18.5 0.15 (4)			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.0%12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.18")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.31")
CSR: TC=0.83/1.00 (F-H:1), BC=0.44/1.00 (N-P:1), WB=0.58/1.00 (F-L:1), SS=0.25/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (A) (INPUT = 0.90)
JSI METAL= 0.78 (M) (INPUT = 1.00)

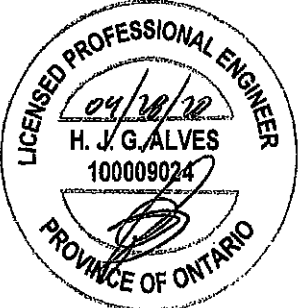


Structural component only
DWG# T-2007640

JOB NAME 408223	TRUSS NAME T30	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:12 2020 Page 1
ID:DMCubINVR8TstFoe3fv6i, zns1l-e3p0mokOMbs3JPPnBvPxphLb5odJb7s02rcVzzMEMX

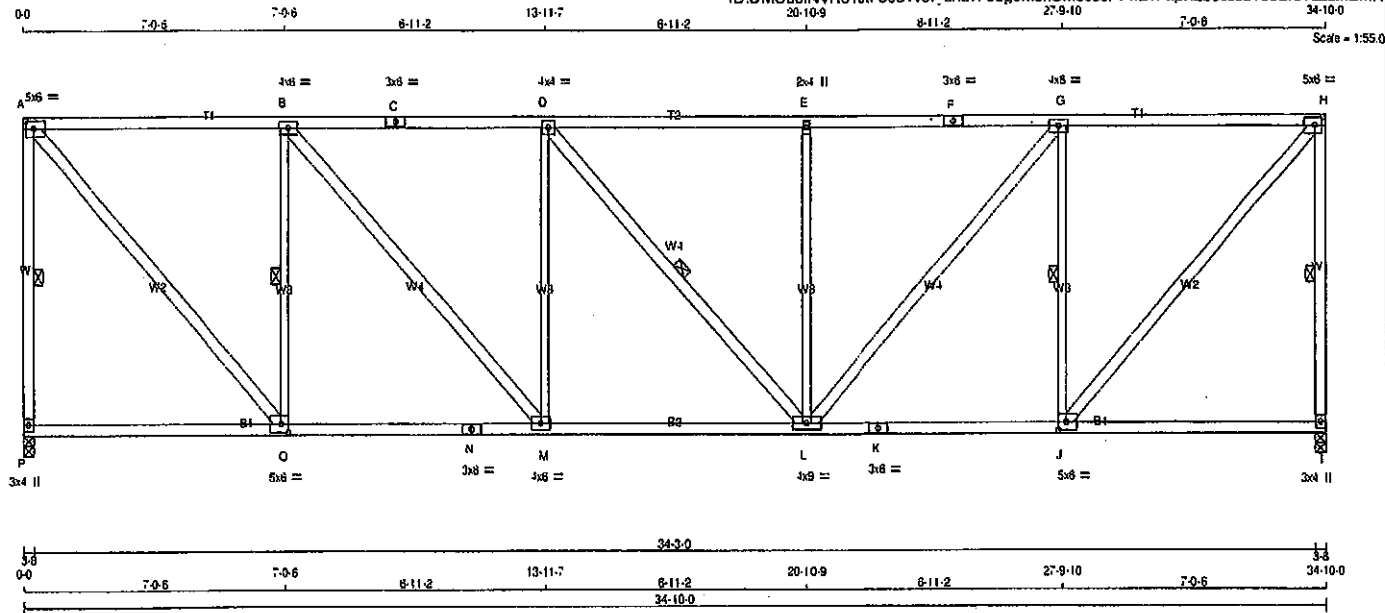

TOTAL WEIGHT = 2 X 179 = 358 lb

LUMBER	CHORDS	SIZE	LUMBER
N. L. G. A. RULES			
P - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
I - H	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
ALL WEBS	2x4	DRY	No.2
EXCEPT			
O - B	2x3	DRY	No.2
M - D	2x3	DRY	No.2
L - E	2x3	DRY	No.2
J - G	2x3	DRY	No.2

DRY, SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWW-1	MT20	5.0	6.0	2.50	2.50
B	TMWW-1	MT20	4.0	6.0		
C	TS-1	MT20	3.0	6.0		
D	TMWW-1	MT20	4.0	4.0		
E	TMWW-1	MT20	2.0	4.0		
F	TS-1	MT20	3.0	6.0		
G	TMWW-1	MT20	4.0	6.0		
H	TMWW-1	MT20	5.0	6.0	2.50	2.50
I	BMV1+p	MT20	3.0	4.0		
J	BMWW-1	MT20	5.0	6.0	2.50	2.50
K	BS-1	MT20	3.0	6.0		
L	BMWW-1	MT20	4.0	6.0		
M	BMWW-1	MT20	4.0	6.0		
N	BS-1	MT20	3.0	6.0		
O	BMWW-1	MT20	5.0	6.0	2.50	2.50
P	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS	REACTION	GROSS	REACTION	BRG	BRG	IN-SX	IN-SX
P	1920	0	1920	0	0	3-8	3-8		
I	1920	0	1920	0	0	3-8	3-8		

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM.	LIVE	WIND	DEAD	SOIL	SOIL
P	1356	891	0	0	0	0	467	0	0
I	1356	891	0	0	0	0	467	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.60 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-P, H-I, 8-O, D-L, G-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
P-A	-1868	0	0.0	0.57 (1)	4.91	A-O	0 2156 0.35 (1)
A-B	-1432	0	-91.8	-91.8 0.78 (1)	4.31	O-B	-1466 0 0.62 (1)
B-C	-2081	0	-91.8	-91.8 0.89 (1)	3.60	B-M	0 985 0.16 (1)
C-D	-2081	0	-91.8	-91.8 0.89 (1)	3.60	M-D	-617 0 0.81 (1)
D-E	-2080	0	-91.8	-91.8 0.68 (1)	4.00	D-L	-2 0 0.00 (1)
E-F	-2080	0	-91.8	-91.8 0.89 (1)	3.60	L-E	-616 0 0.81 (1)
F-G	-2080	0	-91.8	-91.8 0.89 (1)	3.60	L-G	0 984 0.16 (1)
G-H	-1432	0	-91.8	-91.8 0.78 (1)	4.31	J-G	-1465 0 0.62 (1)
H-I	-1868	0	0.0	0.57 (1)	4.91	J-H	0 2156 0.35 (1)
P-O	0 0	-18.5	-18.5 0.22 (4)	10.00			
O-N	0 1432	-18.5	-18.5 0.35 (1)	10.00			
N-M	0 1432	-18.5	-18.5 0.35 (1)	10.00			
M-L	0 2081	-18.5	-18.5 0.42 (1)	10.00			
L-K	0 1432	-18.5	-18.5 0.35 (1)	10.00			
K-J	0 1432	-18.5	-18.5 0.35 (1)	10.00			
J-I	0 0	-18.5	-18.5 0.22 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16')
CALCULATED VERT. DEFL.(LL) = L/999 (0.12')
ALLOWABLE DEFL.(TL) = L/360 (1.16')
CALCULATED VERT. DEFL.(TL) = L/999 (0.24')

CSI: TC=0.89(1.00) (E-G:1), BC=0.42(1.00) (L-M:1),
WB=0.81(1.00) (D-M:1), SSI=0.30(1.00) (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.87 (H) (INPUT = 0.90)
JSI METAL = 0.46 (K) (INPUT = 1.00)



Structural component only
DWG# T-2007641

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T31	5	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:14 2020 Page 1
ID:DMCubINVR6Tsf0e31v6l_zns1l-aRomBTmflD6nZiZAJKRPu6QxnQKq3skJV95c1SzMEMV

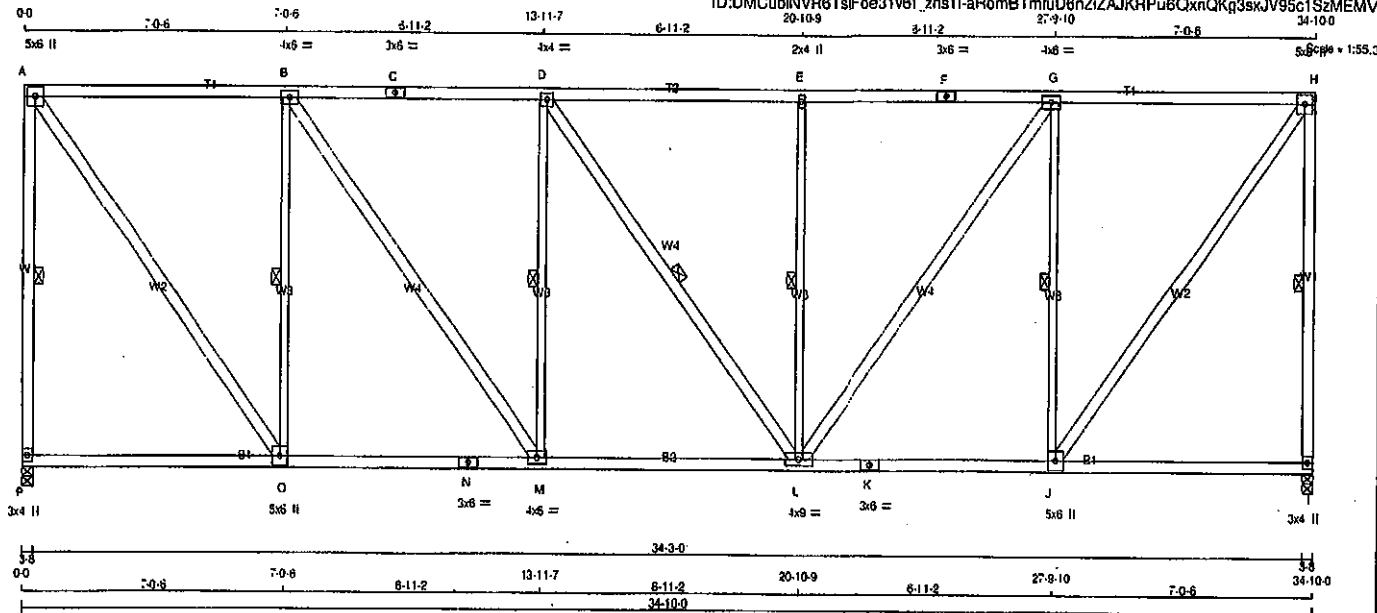

TOTAL WEIGHT = 5 X 198 = 991 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
P - A	2x4 DRY	No. 2	SPF		
A - C	2x4 DRY	No. 2	SPF		
C - F	2x4 DRY	No. 2	SPF		
F - H	2x4 DRY	No. 2	SPF		
I - H	2x4 DRY	No. 2	SPF		
P - N	2x4 DRY	No. 2	SPF		
N - K	2x4 DRY	No. 2	SPF		
K - J	2x4 DRY	No. 2	SPF		
ALL WEBS	2x4 DRY	No. 2	SPF		
EXCEPT					
O - B	2x3 DRY	No. 2	SPF		
M - D	2x3 DRY	No. 2	SPF		
L - E	2x3 DRY	No. 2	SPF		
J - G	2x3 DRY	No. 2	SPF		

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TMVW+P	MT20	5.0	6.0		
B	TMVW+I	MT20	4.0	6.0		
C	TS-I	MT20	3.0	6.0		
D	TMVW+I	MT20	4.0	4.0		
E	TMVW+W	MT20	2.0	4.0		
F	TS-I	MT20	3.0	6.0		
G	TMVW+I	MT20	4.0	6.0		
H	TMVW+I	MT20	5.0	6.0		
I	BMV+P	MT20	3.0	4.0		
J	BMVW+H	MT20	5.0	6.0		
K	BS-I	MT20	3.0	6.0		
L	BMVW+I	MT20	4.0	6.0		
M	BMVW+I	MT20	4.0	6.0		
N	BS-I	MT20	3.0	6.0		
O	BMVW+I	MT20	5.0	6.0		
P	BMV+P	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	8RG	8RG	
JT VERT HORZ	DOWN HORZ UPLIFT	IN-SX	IN-SX	
P 1920 0	1920 0 0	3-8	3-8	
I 1920 0	1920 0 0	3-8	3-8	

UNFACTORED REACTIONS

1ST LOASE	MAX. MIN. COMPONENT REACTIONS						
JT COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
P 1358 891 0	0 0	0 0	0 0	0 0	467 0	0 0	
I 1358 891 0	0 0	0 0	0 0	0 0	467 0	0 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.96 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-P, H-I, B-O, D-M, O-L, E-L, G-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX	MAX. FACTORED	WEBS	MAX. FACTORED	MAX
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CSH (LC)	UNBRAC	MEMB.	FORCE (LBS)	CSH (LC)
FR-TO		FROM TO			FR-TO		
P-A	-1868 0	0.0 0.0 0.88 (1)	4.91	A-O	0 1999	0.32 (1)	
A-B	-1183 0	-91.8 -91.8 0.75 (1)	4.69	O-B	-1466 0	0.96 (1)	
B-C	-1719 0	-91.8 -91.8 0.82 (1)	3.98	B-M	0 916	0.15 (1)	
C-D	-1719 0	-91.8 -91.8 0.82 (1)	3.98	M-D	-917 0	0.41 (1)	
D-E	-1719 0	-91.8 -91.8 0.83 (1)	4.37	D-L	-2 0	0.00 (1)	
E-F	-1719 0	-91.8 -91.8 0.83 (1)	3.98	L-E	-916 0	0.41 (1)	
F-G	-1719 0	-91.8 -91.8 0.83 (1)	3.98	L-G	0 913	0.15 (1)	
G-H	-1183 0	-91.8 -91.8 0.75 (1)	4.69	J-G	-1465 0	0.96 (1)	
H-I	-1868 0	0.0 0.0 0.88 (1)	4.81	J-H	0 2000	0.32 (1)	
P-O	0 0	-18.5 -18.5 0.22 (4)	10.00				
O-N	0 1183	-18.5 -18.5 0.32 (4)	10.00				
N-M	0 1183	-18.5 -18.5 0.32 (4)	10.00				
M-L	0 1719	-18.5 -18.5 0.38 (1)	10.00				
L-K	0 1183	-18.5 -18.5 0.32 (4)	10.00				
K-J	0 1183	-18.5 -18.5 0.32 (4)	10.00				
J-I	0 0	-18.5 -18.5 0.22 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6:00-12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

15% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CSI: TC=0.88/1.00 (H-I), BC=0.38/1.00 (L-M), WB=0.98/1.00 (B-O-I), SSI=0.30/1.00 (G-H-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 610 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (H) (INPUT = 0.99)
JSI METAL = 0.43 (H) (INPUT = 1.00)

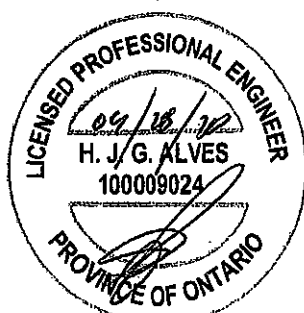


Structural component only
DWG# T-2007642

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T34S	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 9.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 26 10:04:16 2020 Page 1

ID:DMCubINVR6TsFoe31v6t_zns11-WqvXc9ovQqMV00IZQkUizXVSIE5FX?yc2TaJ6KzMEMT

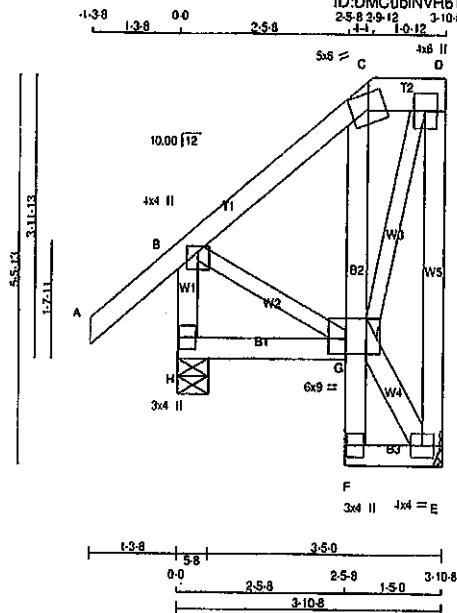

Scale = 1:30.1

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - D	2x6	DRY	No.2	SPF		
E - D	2x4	DRY	No.2	SPF		
H - B	2x4	DRY	No.2	SPF		
H - G	2x4	DRY	No.2	SPF		
F - C	2x4	DRY	No.2	SPF		
F - E	2x4	DRY	No.2	SPF		
ALL WEBS	2x4	DRY	No.2	SPF		
EXCEPT						
B - G	2x3	DRY	No.2	SPF		
G - D	2x3	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTV-m	MT20	5.0	6.0		
D	TMVW+p	MT20	4.0	6.0		
E	BMVW1-i	MT20	4.0	4.0		
F	BMV+p	MT20	3.0	4.0		
G	BVMWVW-i	MT20	6.0	9.0	2.50	3.00
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	214	0	214	0	0	MECHANICAL	5-8
H	341	0	341	0	0	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	151	99.0	0.0	0.0	0.0	62.0	0.0
H	239	170.0	0.0	0.0	0.0	69.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. CS (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0.41	-91.8	-91.8	0.14 (5)	G-E	-6.0	0.00 (1)
B-C	-62.0	-91.8	-91.8	0.12 (1)	B-G	0.53	0.01 (1)
C-D	-51.0	-91.8	-91.8	0.01 (1)	G-D	0.154	0.03 (1)
E-D	-197.0	0.0	0.0	0.10 (1)			
H-B	-317.0	0.0	0.0	0.03 (1)			
H-G	0.0	-18.5	-18.5	0.04 (4)			
F-G	0.13	0.0	0.0	0.01 (1)			
G-C	-138.0	0.0	0.0	0.01 (1)			
F-E	0.4	-18.5	-18.5	0.01 (4)			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.14:1.00 (A-B:5), BC=0.04:1.00 (G-H:4), WB=0.03:1.00 (D-G:1), SSI=0.09:1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(FSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.24 (B) INPUT = 0.90
JSI METAL=0.06 (B) INPUT = 1.00



Structural component only
DWG# T-2007644


JOB NAME 408223	TRUSS NAME T35S	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Tue Apr 26 10:04:17 2020 Page 1

ID:DMCubINVR6TstFos31v6l_zns1l-OTvpVoXB8UMQAHl_S76W2dVdRQGSEmC7KGenzMEMS

Scale = 1/2" = 1'-0"

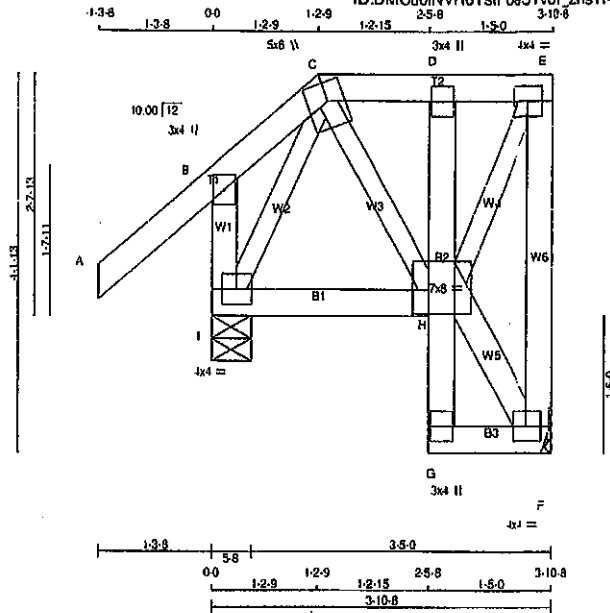

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
I - B	2x4	DRY	No.2	SPF	
I - H	2x4	DRY	No.2	SPF	
G - D	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT H - F	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV-p	MT20	3.0	4.0		
C	TTWW-m	MT20	5.0	6.0	2.50	2.25
D	TMV-p	MT20	3.0	4.0		
E	TMVW-1	MT20	4.0	4.0		
F	BMVW-1	MT20	3.0	4.0		
G	BMV-p	MT20	3.0	4.0		
H	BVMWVW-1	MT20	7.0	8.0	3.25	2.25
I	BMVW-1	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS								
	FACTORED		MAXIMUM FACTORED			INPUT	REQD	
	GROSS REACTION		GROSS REACTION			BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
F	191	0	191	0	0	MECHANICAL		
I	363	0	363	0	0	5-8	5-8	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST LOOSE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	135	88	-13	0	0	0	49	0
I	254	183	0	0	0	0	72	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (I/C)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (I/C)	UNBRACED LENGTH
FR-TO		FROM TO		FR-TO			
A-B	0 41	-91.8 -91.8	0.14 (5)	10.00	H-F	-6 0	0.00 (1)
B-C	-45 0	-91.8 -91.8	0.14 (5)	8.25	H-E	0 141	0.03 (1)
C-D	-69 0	-91.8 -91.8	0.02 (1)	6.25	C-H	0 48	0.01 (1)
D-E	-67 0	-91.8 -91.8	0.02 (1)	6.25	I-C	-96 28	0.02 (1)
F-E	-175 0	0.0 0.0	0.05 (1)	7.81			
I-B	-255 0	0.0 0.0	0.03 (1)	7.81			
I-H	-13 45	-18.5 -18.5	0.04 (4)	6.25			
G-H	0 13	0.0 0.0	0.01 (1)	10.00			
H-D	-135 0	0.0 0.0	0.01 (1)	7.81			
G-F	0 4	-18.5 -18.5	0.01 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.14/1.00 (A-B:5), BC=0.04/1.00 (H-I:4), WB=0.03/1.00 (E-H:1), SS=0.09/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	818	354	1887	788	1987	1656

PLATE PLACEMENT TOL. = 0.25 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (E) INPUT = 0.90
JSI METAL= 0.09 (B) INPUT = 1.00



Structural component only
DWG# T-2007645

JOB NAME 408223	TRUSS NAME T36	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:04:18 2020 Page 1 ID:DMCubINVR6TslFoe31v8l zns1l-TC1H0rp9yRcD1KsxY9WL2ybo51j27vNvQn3qBDzMEMR	

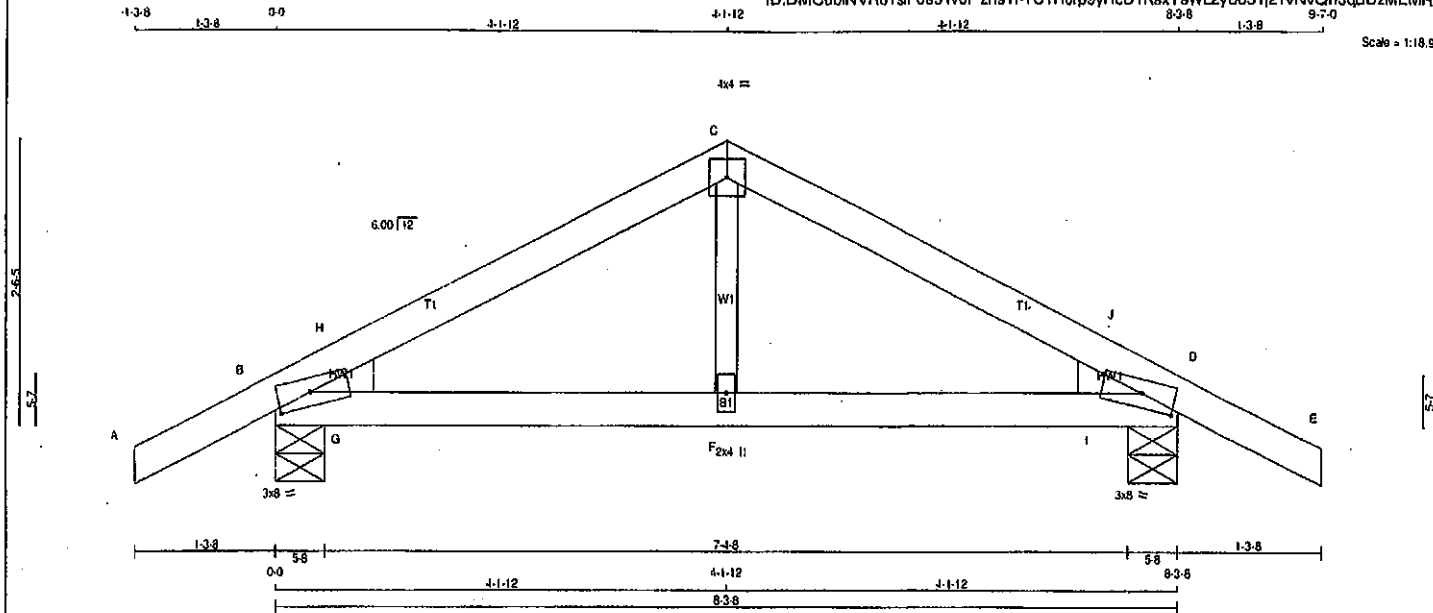

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
B - D	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMBH1-m	MT20	3.0	8.0 1.50 3.75
C	TTW-p	MT20	4.0	4.0
D	TMBH1-m	MT20	3.0	8.0 1.50 3.75
F	BMW-w	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	HORZ	BRG	IN-SX	BRG	IN-SX
B	582	0	582	0	0	5-8	5-8	5-8	5-8
D	582	0	582	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	409	282	0	0	0	127	0
D	409	282	0	0	0	127	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO	0 23	FROM TO		FR-TO	0 170		
A-B	-539	-91.8 -91.8 0.12 (1)	10.00	F-C	-158	3	0.04 (1)
B-H	-539	-91.8 -91.8 0.04 (1)	6.25	G-H	-158	3	0.00 (1)
H-C	-525	-91.8 -91.8 0.15 (1)	6.25	I-J	-158	3	0.00 (1)
C-J	-525	-91.8 -91.8 0.15 (1)	6.25				
J-D	-539	-91.8 -91.8 0.04 (1)	6.25				
D-E	0 23	-91.8 -91.8 0.12 (1)	10.00				
B-G	0 465	-18.5 -18.5 0.21 (1)	10.00				
G-F	0 465	-18.5 -18.5 0.21 (1)	10.00				
F-I	0 465	-18.5 -18.5 0.21 (1)	10.00				
I-D	0 465	-18.5 -18.5 0.21 (1)	10.00				

TOTAL WEIGHT = 3 X 27 = 80 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.8	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.28")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.28")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.15, (C-J)=1, BC=0.21, (F-I)=1, WB=0.04, (I-C)=1, SS=0.12, (I-C)=1

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.25 (B) (INPUT = 0.90)
JSI METAL = 0.11 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007646

JOB NAME 408223	TRUSS NAME G36	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:03:49 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns1l-pdnKwTznXyK38MLaVXNnrubLI5ioKemmmYnfPzMEMU

1-3.8 1-3.8 0-0 2-1-12 2-1-12 2-0-0 4-1-12 2-0-0 6-1-12 2-1-12 8-3-8 1-5-0
Scale = 1:10,1

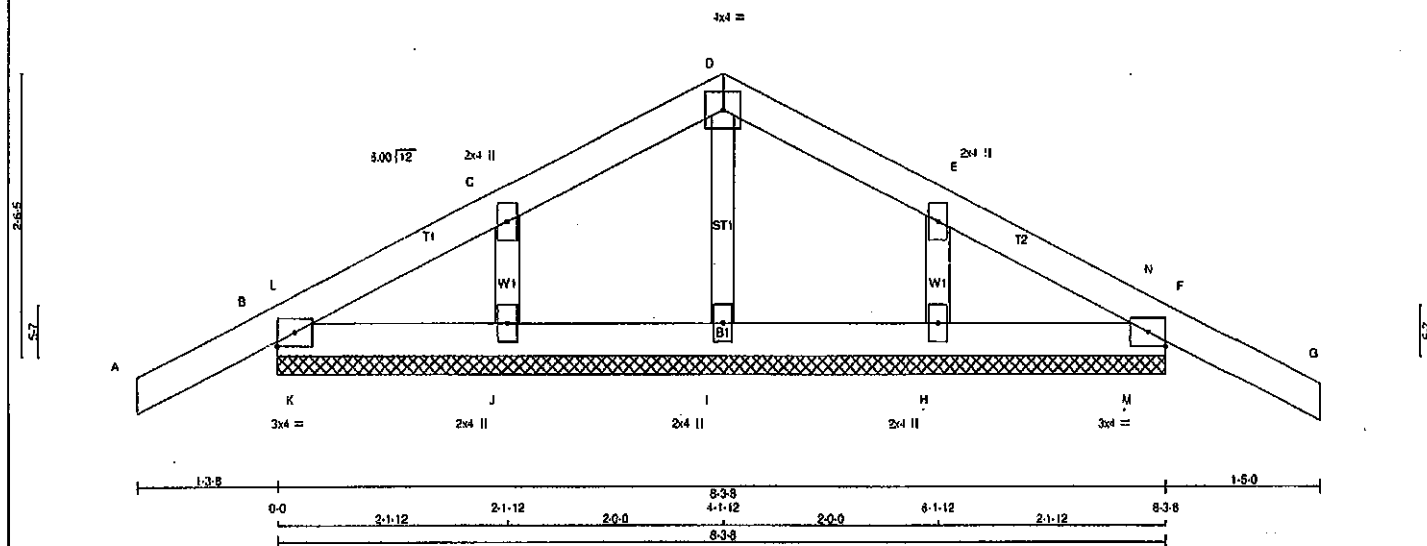

LUMBER	CHORDS	SIZE	DRY	No.2	DESCR.	SPF
N. L. G. A. RULES	A - D	2x4	DRY	No.2	SPF	
	D - G	2x4	DRY	No.2	SPF	
	G - F	2x4	DRY	No.2	SPF	
	ALL WEBS	2x3	DRY	No.2	SPF	
	ALL GABLE WEBS	2x3	DRY	No.2	SPF	
	DRY: SEASONED LUMBER.					

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0			Edge
C	TMB1-w	MT20	2.0	4.0			
D	TTW-p	MT20	4.0	4.0			
E	TMB1-w	MT20	2.0	4.0			
F	TMB1-I	MT20	3.0	4.0			Edge
H, I, J	BMB1-w	MT20	2.0	4.0			

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED CS (LC)	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)
FR-TO	A-B	0 23	-91.8	-91.8 0.12 (1)	10.00	FR-TO	I-D	-115 0	0.02 (1)
	B-L	-61 0	-91.8	-91.8 0.01 (4)	6.25		J-C	-218 0	0.03 (1)
	L-C	-39 0	-91.8	-91.8 0.06 (1)	6.25		H-E	-218 0	0.03 (1)
	C-D	-45 0	-91.8	-91.8 0.06 (1)	6.25		K-L	-52 7	0.00 (1)
	D-E	-45 0	-91.8	-91.8 0.06 (1)	6.25		M-N	-52 7	0.00 (1)
	E-N	-39 0	-91.8	-91.8 0.06 (1)	6.25				
	N-F	-61 0	-91.8	-91.8 0.01 (4)	6.25				
	F-G	0 25	-91.8	-91.8 0.14 (1)	10.00				
	B-K	0 44	-18.5	-18.5 0.03 (1)	10.00				
	K-J	0 44	-18.5	-18.5 0.03 (1)	10.00				
	J-I	0 32	-18.5	-18.5 0.02 (1)	10.00				
	I-H	0 32	-18.5	-18.5 0.02 (1)	10.00				
	H-M	0 44	-18.5	-18.5 0.03 (1)	10.00				
	M-F	0 44	-18.5	-18.5 0.03 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 085-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.14/1.00 (F-G:1), BC=0.03/1.00 (H-M:1), WB=0.03/1.00 (E-H:1), SSI=0.10/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.21 (B) INPUT = 0.90
JSI METAL= 0.09 (C) INPUT = 1.00




Structural component only
DWG# T-2007621

JOB NAME 408223	TRUSS NAME T37	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEx Industries, Inc. Tue Apr 28 10:04:19 2020 Page 1
ID:DMCubINVR6TstF0e31v6I_zns11-xPbIEBQnk4IUR761tabA7yUR47k72RpNlfzMEMQ

Scale = 1:12.0

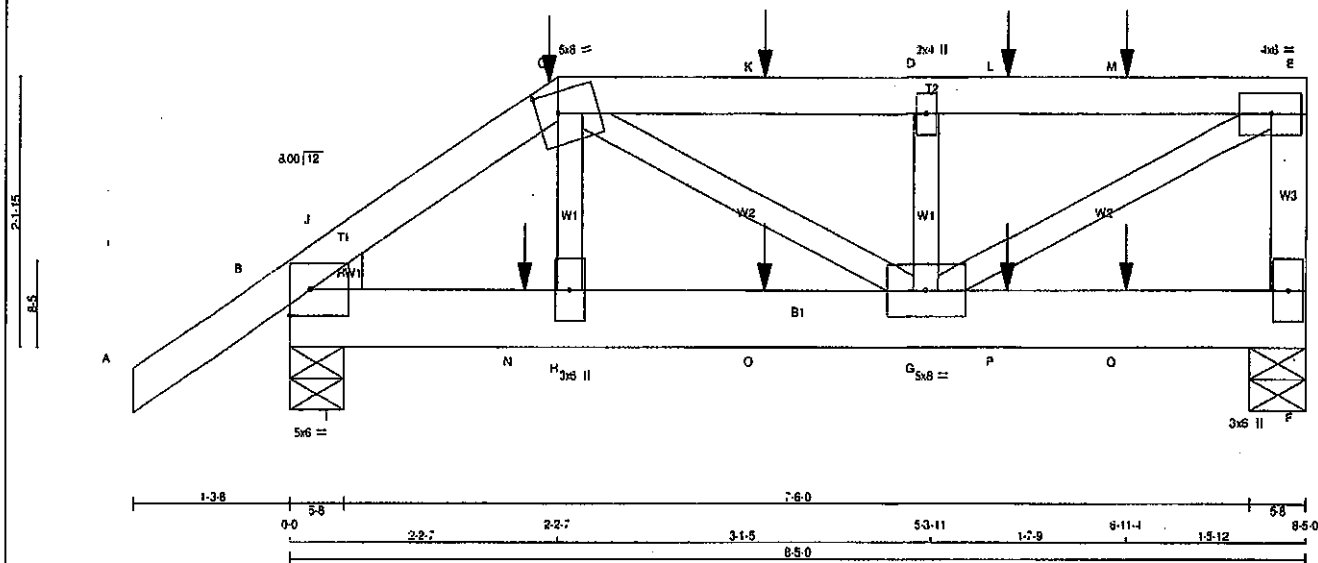

TOTAL WEIGHT = 37 lb

LUMBER				N. L. G. A. RULES	
CHORDS	SIZE	LUMBER	DESCR.	SPF	
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
B - F	2x6	DRY	No.2	SPF	
ALL WEBS 2x3 DRY No.2				SPF	
DRY: SEASONED LUMBER.					

PLATES (Table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TM6H1-1	MT20	5.0	6.0 Edge
C	TTWV-m	MT20	5.0	6.0 2.00 2.00
D	TMW-w	MT20	2.0	4.0
E	TMVW-1	MT20	4.0	6.0
F	BMV1-p	MT20	3.0	6.0
G	BMVWW-1	MT20	5.0	6.0
H	BMV-w	MT20	3.0	6.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRO		HEEL	
JT	VERT	GROSS REACTION	HORZ	DOWN	HORZ	BRG	IN-SX	IN-SX	WEDGE		
F	760	0	0	760	0	5-8	5-8	5-8			
B	823	0	0	823	0	5-8	5-8	5-8	2x4 L		

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS									
F	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL				
F	537	352.0	0.0	0.0	0.0	185.0	0.0				
B	580	392.0	0.0	0.0	0.0	188.0	0.0				

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS) F, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 26	-91.8 -91.8 0.13 (1)	10.00	H-C	0 73	0.02 (4)	
B-J	-1068 0	-91.8 -91.8 0.08 (1)	5.99	C-G	0 252	0.08 (1)	
J-C	-860 0	-91.8 -91.8 0.08 (1)	6.25	G-D	-528 0	0.09 (1)	
C-K	-923 0	-91.8 -91.8 0.24 (1)	6.09	G-E	0 1062	0.28 (1)	
K-D	-923 0	-91.8 -91.8 0.24 (1)	6.09	I-J	0 207	0.00 (1)	
D-L	-924 0	-91.8 -91.8 0.24 (1)	6.09				
L-M	-924 0	-91.8 -91.8 0.24 (1)	6.09				
M-E	-924 0	-91.8 -91.8 0.24 (1)	6.09				
F-E	-682 0	0.0 0.0 0.08 (1)	7.81				
B-I	0 701	-18.5 -18.5 0.14 (1)	10.00				
I-N	0 701	-18.5 -18.5 0.14 (1)	10.00				
N-H	0 701	-18.5 -18.5 0.14 (1)	10.00				
H-O	0 705	-18.5 -18.5 0.15 (1)	10.00				
O-G	0 705	-18.5 -18.5 0.15 (1)	10.00				
G-P	0 0	-18.5 -18.5 0.07 (1)	10.00				
P-Q	0 0	-18.5 -18.5 0.07 (1)	10.00				
Q-F	0 0	-18.5 -18.5 0.07 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	2-2-7	-88	-88	---	FRONT	VERT	TOTAL	---	C1
K	3-11-4	-83	-83	---	FRONT	VERT	TOTAL	---	C1
L	5-11-4	-83	-83	---	FRONT	VERT	TOTAL	---	C1
M	6-11-4	-83	-83	---	FRONT	VERT	TOTAL	---	C1
N	1-11-4	-48	-48	---	FRONT	VERT	TOTAL	---	C1
O	3-11-4	-48	-48	---	FRONT	VERT	TOTAL	---	C1
P	5-11-4	-48	-48	---	FRONT	VERT	TOTAL	---	C1
Q	6-11-4	-48	-48	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.28")

CALCULATED VERT. DEFL.(LL) = L/999 (0.01")

ALLOWABLE DEFL.(TL) = L/360 (0.28")

CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.24/1.00 (D-E:1), BC=0.15/1.00 (G-H:1),

WB=0.25/1.00 (E-G:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	818	354	1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

ISI GRIP= 0.61 (E) (INPUT = 0.90)

ISI METAL= 0.24 (E) (INPUT = 1.00)



Structural component only
DWG# T-2007647

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:03:50 2020 Page 1
ID:DMCubINVR6TslFoa31v6l zns11-HqL8GTbYr4Bq0ZvH0mw2R1a1DRB8mn_QHLBrzMEM
27-6-0 289-8
Scale = 1:54

LUMBER
N. L. G. A. RULES
CHORDS SIZE DRY LUMBER DESCR.
AG - B 2x4 DRY No.2 SPF
A - G 2x4 DRY No.2 SPF
G - K 2x4 DRY No.2 SPF
K - Q 2x4 DRY No.2 SPF
R - P 2x4 DRY No.2 SPF
AG - X 2x4 DRY No.2 SPF
X - R 2x4 DRY No.2 SPF
ALL WEBS 2x3 DRY No.2 SPF
ALL GABLE WEBS 2x3 DRY No.2 SPF
DRY: SEASONED LUMBER.
GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table in inches)
JT TYPE PLATES W LEN Y X
B TMVW+p MT20 4.0 4.0 1.00 2.00
C, D, E, F, H, I, J, L, M, N, O
C TMW+w MT20 2.0 4.0
G TTW-m MT20 4.0 4.0
K TTW-m MT20 4.0 4.0
P TMVW+p MT20 4.0 4.0 1.00 2.00
R BMV1+p MT20 3.0 4.0
S BMWV1-l MT20 4.0 4.0
T, U, V, W, Y, Z, AA, AB, AC, AD, AE
T BMW1+w MT20 2.0 4.0
X BS-1 MT20 3.0 6.0
AF BMWV1-l MT20 4.0 4.0
AG BMV1+p MT20 3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER
BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)
BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.
1 LATERAL BRACE(S) AT 1/2 LENGTH OF K-W, J-Y, I-Z, H-AA, G-AB.
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW
LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
AG-B	-292 0	0.0	0.0 0.03 (1)	7.81	W-K	-140 0	0.09 (1)
A-B	0 41	-91.8	-91.8 0.13 (1)	10.00	Y-J	-210 0	0.14 (1)
B-C	-80 0	-91.8	-91.8 0.12 (1)	6.25	Z-1	-181 0	0.12 (1)
C-D	-23 0	-91.8	-91.8 0.05 (1)	6.25	AA-H	-182 0	0.12 (1)
D-E	-38 0	-91.8	-91.8 0.05 (1)	6.25	V-L	-203 0	0.27 (1)
E-F	-19 0	-91.8	-91.8 0.05 (1)	6.25	U-M	-175 0	0.13 (1)
F-G	-23 0	-91.8	-91.8 0.05 (1)	6.25	T-N	-192 0	0.07 (1)
G-H	-12 0	-91.8	-91.8 0.04 (1)	6.25	S-O	-126 0	0.02 (1)
H-I	-12 0	-91.8	-91.8 0.04 (1)	6.25	AB-G	-121 0	0.08 (1)
I-J	-12 0	-91.8	-91.8 0.05 (1)	6.25	AC-F	-202 0	0.27 (1)
J-K	-12 0	-91.8	-91.8 0.05 (1)	6.25	AD-E	-176 0	0.13 (1)
K-L	-30 0	-91.8	-91.8 0.05 (1)	6.25	AE-D	-192 0	0.07 (1)
L-M	-19 0	-91.8	-91.8 0.05 (1)	6.25	AF-C	-126 0	0.02 (1)
M-N	-26 0	-91.8	-91.8 0.05 (1)	6.25	B-AF	0 32	0.01 (1)
N-O	-24 0	-91.8	-91.8 0.05 (1)	6.25	S-P	0 32	0.01 (1)
O-P	-60 0	-91.8	-91.8 0.12 (1)	6.25			
P-O	0 41	-91.8	-91.8 0.13 (1)	10.00			
R-P	-293 0	0.0	0.0 0.03 (1)	7.81			
AG-AF	0 0	-18.5	-18.5 0.02 (4)	10.00			
AF-AE	0 23	-18.5	-18.5 0.02 (4)	10.00			
AE-AD	0 19	-18.5	-18.5 0.02 (4)	10.00			
AD-AC	0 16	-18.5	-18.5 0.02 (4)	10.00			
AC-AB	0 14	-18.5	-18.5 0.02 (4)	10.00			
AB-AA	0 12	-18.5	-18.5 0.01 (4)	10.00			
AA-Z	0 12	-18.5	-18.5 0.02 (4)	10.00			
Z-Y	0 12	-18.5	-18.5 0.02 (4)	10.00			
Y-X	0 12	-18.5	-18.5 0.02 (4)	10.00			
X-W	0 12	-18.5	-18.5 0.02 (4)	10.00			
W-V	0 14	-18.5	-18.5 0.02 (4)	10.00			
V-U	0 16	-18.5	-18.5 0.02 (4)	10.00			
U-T	0 19	-18.5	-18.5 0.02 (4)	10.00			
T-S	0 23	-18.5	-18.5 0.02 (4)	10.00			
S-R	0 0	-18.5	-18.5 0.02 (4)	10.00			

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF
SPACING = 21.0 IN. C/C
LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015
THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014
DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.
155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD
CSI: TC=0.13:1.00 (P-O:1), BC=0.02:1.00 (S-T:4), WB=0.27 1.00 (L-V:1), SSI=0.09:1.00 (J-K:1)
DOL LUMBER=1

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T40	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:57 2020 Page 2	
				ID:DMCubINVR6TstFoe31v8I zns1I-TsGG6wA9pyw Bd8P2lsXcz APYAIVTa7LN10dlzME7m	

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	X
B	TMVW-p	MT20	4.0	12.0	1.00 5.50
C	TTWW+m	MT20	7.0	8.0	Edge
D	TMWW-l	MT20	5.0	6.0	
E	TMW+w	MT20	3.0	6.0	
F	TS-l	MT20	5.0	6.0	
G	TMWW-t	MT20	5.0	6.0	
H	TTWW+m	MT20	7.0	8.0	Edge
I	TMVW-p	MT20	4.0	12.0	1.00 5.50
K	BMV1+p	MT20	3.0	5.0	
L	BMWW-l	MT20	5.0	8.0	2.50 3.00
M	BMWW-l	MT20	5.0	8.0	2.50 3.25
N	BS-l	MT20	6.0	9.0	
O	BMWW-l	MT20	5.0	8.0	
P	BS-l	MT20	6.0	9.0	
Q	BMWW-l	MT20	5.0	8.0	2.50 3.25
R	BMWW-l	MT20	5.0	8.0	2.50 3.00
S	BMV1+p	MT20	3.0	6.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	17-7-0	-110	-110	---	FRONT	VERT	TOTAL	---	C1
G	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	29-3-6	-429	-429	---	FRONT	VERT	TOTAL	---	C1
L	29-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
M	23-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
N	21-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
O	17-7-0	-28	-28	---	FRONT	VERT	TOTAL	---	C1
P	13-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
Q	11-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	19-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	21-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	1-11-4	-25	-26	---	FRONT	VERT	TOTAL	---	C1
AC	3-11-4	-28	-26	---	FRONT	VERT	TOTAL	---	C1
AD	7-11-4	-28	-26	---	FRONT	VERT	TOTAL	---	C1
AE	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AF	15-11-4	-28	-26	---	FRONT	VERT	TOTAL	---	C1
AG	19-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	25-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	27-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	31-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	33-2-12	-25	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007660

JOB NAME 408224	TRUSS NAME T40Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	---------------------------	----------------------	-----------------	--------------------------------------	-------------	----------


Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:19:58 2020 Page 1

ID:DMCubINVR6TstFoe31v6l zns11-x2q8JGB0aF2pn|bcaNm8BWHeyQ8EpcGaimZakzME7l

1-3-8 0-0 5-10-8 5-10-8 5-10-14 11-9-8 5-9-10 17-7-0 18-8-4 1-1-4 2-0-0 20-8-4 22-4-12 2-1-10 5-10-14 29-3-8 39-2-0 38-5-8 1-3-8

Scale = 1/8" = 1'-0"

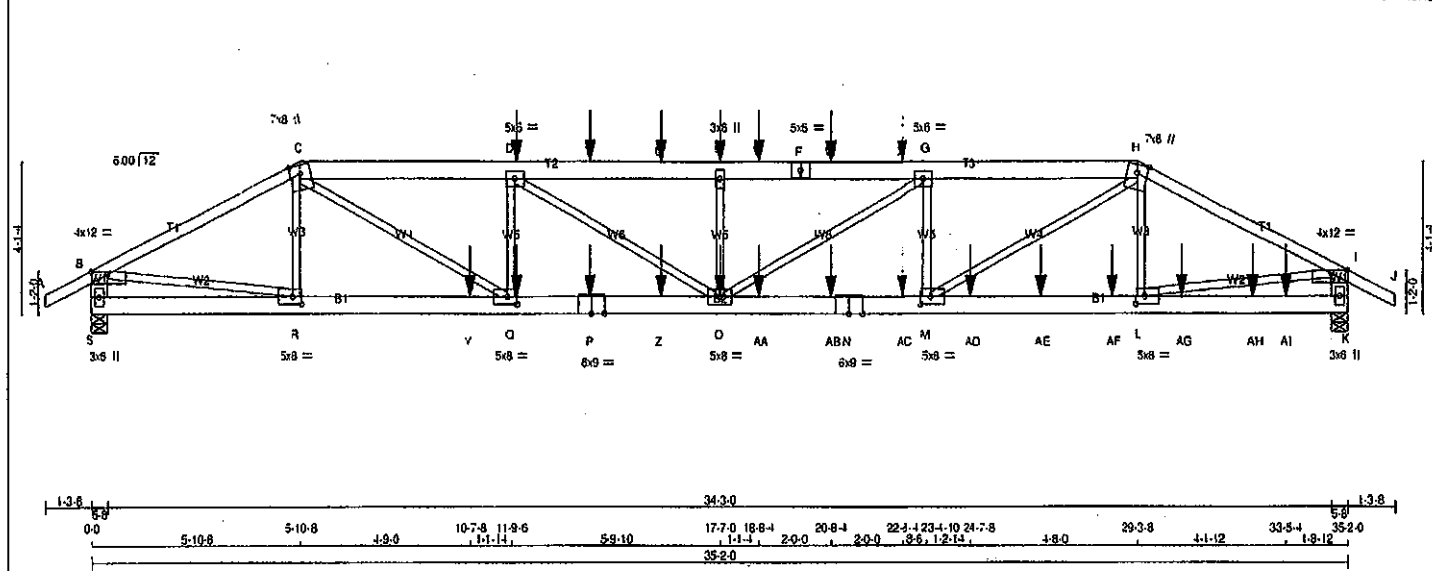

34-3-0 1-3-8 0-0 5-10-8 5-10-8 4-9-0 10-7-8 11-9-6 1-1-4 5-9-10 17-7-0 18-8-4 1-1-4 2-0-0 20-8-4 22-4-12 2-1-10 24-7-8 4-8-0 29-3-8 4-1-12 33-5-4 35-2-0 1-3-8

TOTAL WEIGHT = 2 X 169 = 338 lb

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. A - C 2x4 DRY No.2 SPF C - F 2x6 DRY No.2 SPF F - H 2x6 DRY No.2 SPF H - J 2x4 DRY No.2 SPF S - B 2x6 DRY No.2 SPF K - I 2x6 DRY No.2 SPF S - P 2x6 DRY 1650F 1.5E SPF P - N 2x6 DRY 1650F 1.5E SPF N - K 2x6 DRY 1650F 1.5E SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT DRY: SEASONED LUMBER. DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS: CHORDS #ROWS SURFACE SPACING (IN) LOAD/PLF TOP CHORDS : (0.122"x3") SPIRAL NAILS A-C 1 12 TOP H-J 1 12 TOP C-F 2 12 SIDE(183.1) F-H 2 12 SIDE(0.0) S-B 2 12 TOP K-I 2 12 TOP BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS S-P 2 12 SIDE(183.1) P-N 2 12 SIDE(183.1) N-K 2 12 SIDE(0.0) WEBS : (0.122"x3") SPIRAL NAILS 2x3 1 8 NAILS TO BE DRIVEN FROM ONE SIDE ONLY. GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS. TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.			
DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 25.6 PSF DL = 8.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 38.0 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF BCBC 2018, OBC 2012, ABC 2019 - PART 9 OF OBC 2012 (2019 AMENDMENT) - CSA 086-09, CSA 086-14 - TPIC 2011, TPIC 2014 55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL) = L/360 (1.17") CALCULATED VERT. DEFL.(LL) = L/999 (0.32") ALLOWABLE DEFL.(TL) = L/360 (1.17") CALCULATED VERT. DEFL.(TL) = L/718 (0.59") CSI: TC=0.81-1.00 (H-I); BC=0.71-1.00 (M-O); WB=0.90-1.00 (L-L); SS=0.64-1.00 (L-M); DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00 COMPANION LIVE LOAD FACTOR = 1.00 AUTOSOLVE HEELS OFF TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1887 788 1987 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.89 (R) (INPUT = 0.90) JSI METAL= 0.93 (P) (INPUT = 1.00)			
DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED MAXIMUM FACTORED INPUT REQD GROSS REACTION GROSS REACTION BRG BRG JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX S 4161 0 4161 0 0 5-8 5-8 K 5042 0 5042 0 0 5-8 5-8 UNFACTORED REACTIONS 1ST CASE SNOW MIN. COMPONENT REACTIONS JT COMBINED LIVE PERM.LIVE WIND DEAD SOIL S 2938 1985 0 0 0 0 970 0 0 0 K 3552 2409 0 0 0 0 0 0 1143 0 0 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS) S, K BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.95 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS MAX. FACTORED WEBS MAX. FACTORED MEMB. FORCE VERT. LOAD LC1 MAX. MAX. MEMB. FORCE VERT. LOAD LC1 MAX. MAX. (LBS) (PLF) CSI (LC) UNBRAC (LBS) CSI (LC) FR-TO LENGTH FR-TO A-B 0 28 -91.8 -91.8 0.07 (1) 10.00 R-C -470 0 0.08 (1) B-C -6650 0 -91.8 -91.8 0.66 (1) 3.34 C-Q 0 5608 0.69 (1) C-D -10735 0 -91.8 -91.8 0.33 (1) 3.55 Q-D -1878 0 0.20 (1) D-T -12119 0 -91.8 -91.8 0.40 (1) 3.30 D-O 0 -1838 0.20 (1) T-U -12119 0 -91.8 -91.8 0.40 (1) 3.30 O-E -1004 0 0.12 (1) U-E -12119 0 -91.8 -91.8 0.40 (1) 3.30 O-G -46 33 0.02 (1) E-V -12119 0 -91.8 -91.8 0.45 (1) 3.23 M-G -826 0 0.10 (1) V-F -12119 0 -91.8 -91.8 0.45 (1) 3.23 M-H 0 5832 0.72 (1) F-W -12119 0 -91.8 -91.8 0.45 (1) 3.23 L-H 0 57 0.01 (4) W-X -12119 0 -91.8 -91.8 0.45 (1) 3.23 B-R 0 6014 0.74 (1) X-G -12119 0 -91.8 -91.8 0.45 (1) 3.23 L-I 0 7274 0.90 (1) G-H -12159 0 -91.8 -91.8 0.39 (1) 3.30 H-I -8042 0 -91.8 -91.8 0.81 (1) 2.95 I-J 0 28 -91.8 -91.8 0.07 (1) 10.00 S-B -4141 0 0.0 0.0 0.15 (1) 7.00 K-I -4926 0 0.0 0.0 0.17 (1) 6.55 S-R 0 0 -18.5 -18.5 0.05 (1) 10.00 R-Y 0 5974 -18.5 -18.5 0.44 (1) 10.00 Y-Q 0 5974 -18.5 -18.5 0.44 (1) 10.00 Q-P 0 10734 -18.5 -18.5 0.54 (1) 10.00 P-Z 0 10734 -18.5 -18.5 0.54 (1) 10.00 Z-O 0 10734 -18.5 -18.5 0.54 (1) 10.00 O-AA 0 12159 -18.5 -18.5 0.71 (1) 10.00 AA-AB 0 12159 -18.5 -18.5 0.71 (1) 10.00 AB-N 0 12159 -18.5 -18.5 0.71 (1) 10.00 N-AC 0 12159 -18.5 -18.5 0.71 (1) 10.00 AC-M 0 12159 -18.5 -18.5 0.71 (1) 10.00 M-AD 0 7208 -18.5 -18.5 0.69 (1) 10.00 AD-AE 0 7208 -18.5 -18.5 0.69 (1) 10.00 AE-AF 0 7208 -18.5 -18.5 0.69 (1) 10.00 AF-L 0 7208 -18.5 -18.5 0.69 (1) 10.00 L-AG 0 0 -18.5 -18.5 0.18 (1) 10.00 AG-AH 0 0 -18.5 -18.5 0.18 (1) 10.00 AH-AI 0 0 -18.5 -18.5 0.18 (1) 10.00 AI-K 0 0 -18.5 -18.5 0.18 (1) 10.00 FACTORED CONCENTRATED LOADS (LBS) JT LOC. LC1 MAX. MAX. FACE DIR. TYPE HEEL CONN. D 11-11-4 -110 -110 --- BACK VERT TOTAL --- C1 E 17-7-0 -110 -110 --- BACK VERT TOTAL --- C1 O 17-7-0 -26 -26 --- BACK VERT TOTAL --- C1 P 13-11-4 -26 -26 --- BACK VERT TOTAL --- C1			



Structural component only
DWG# T-2007661

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T40Z	1	2	GREEN PARK HOMES	
Tamarack Pool Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Tue Apr 28 10:19:58 2020 Page 2

ID:DMCubINVR6TslFoa31v6l_zns1l-x2qeJGBoaF2pnibCaNm9BWHeyO8EpcGa1mZAkzME7l

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	12.0	1.00	5.50
C	TTWW+m	MT20	7.0	8.0	Edge	
D	TMWW-l	MT20	5.0	6.0		
E	TMW+rw	MT20	3.0	6.0		
F	TS-l	MT20	5.0	6.0		
G	TMWW-l	MT20	5.0	6.0		
H	TTWW+m	MT20	7.0	8.0	Edge	
I	TMVW-p	MT20	4.0	12.0	1.00	5.50
K	BMV1+p	MT20	3.0	6.0		
L	BMWW-l	MT20	5.0	8.0	2.50	3.00
M	BMWW-l	MT20	5.0	8.0	2.50	3.25
N	BS-l	MT20	6.0	9.0		
O	BMWW-l	MT20	5.0	8.0		
P	BS-l	MT20	6.0	9.0		
Q	BMWW-l	MT20	5.0	8.0	2.50	3.25
R	BMWW-l	MT20	5.0	8.0	2.50	3.00
S	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
Q	11-11-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
T	13-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
U	15-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	18-8-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
W	20-8-4	-159	-159	---	BACK	VERT	TOTAL	---	C1
X	22-8-4	-159	-159	---	BACK	VERT	TOTAL	---	C1
Y	10-7-8	-1171	-1171	---	BACK	VERT	TOTAL	---	C1
Z	15-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AA	18-8-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AB	20-8-4	-32	-32	---	BACK	VERT	TOTAL	---	C1
AC	22-8-4	-32	-32	---	BACK	VERT	TOTAL	---	C1
AD	24-7-8	-2237	-2237	---	BACK	VERT	TOTAL	---	C1
AE	26-8-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AF	28-8-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AG	30-8-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AH	32-6-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AI	33-5-4	-121	-121	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

11 C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.





Structural component only
DWG# T-2007661 *7/2*

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ORWG NO.
408224	T41	2	1	GREEN PARK HOMES	
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:59 2020 Page 1
ID:DMCubINVR6TstF0e31v6I zns11-PFO0W6COLZAiOxloAHu?h03QDMnRzi?PphW7iAzME7k

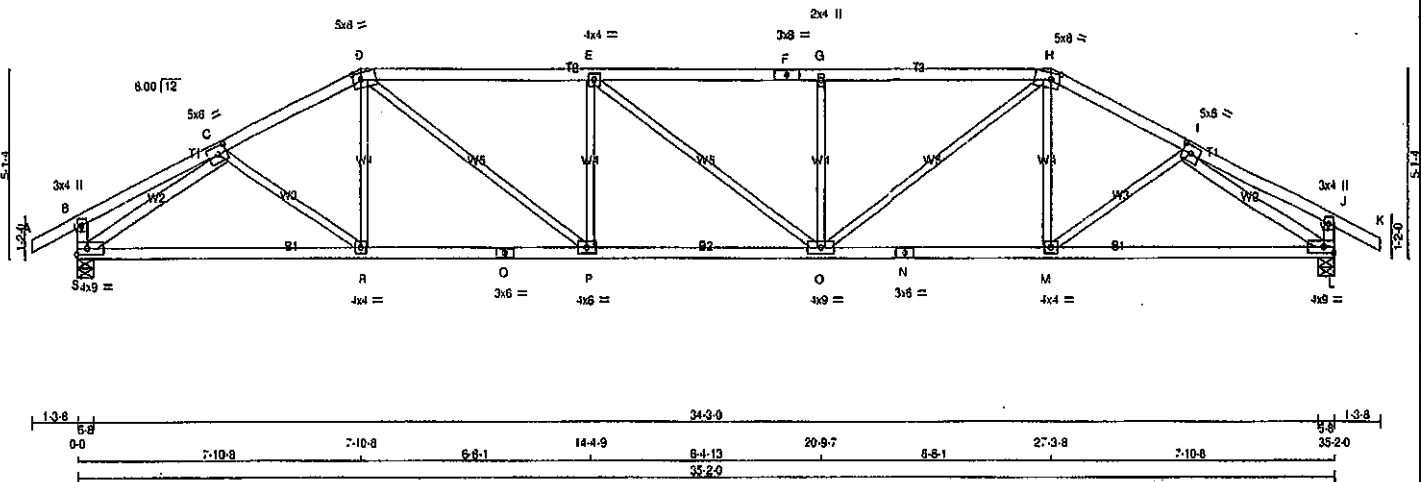

TOTAL WEIGHT = 2 X 139 = 278 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - O	2x4	DRY	No.2
O - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
S	2063	0	2063	0	5-8
L	2063	0	2063	0	5-8

UNFACTORED REACTIONS		1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
S	1457	989	0
L	1457	989	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.94 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD LC1	MAX. (PLF)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX. (PLF)
FR-TO					FR-TO		
A-B	0 28	-91.8	-91.8 0.12 (1)	10.00	C-R	0 93	0.03 (4)
B-C	0 15	-91.8	-91.8 0.20 (1)	10.00	R-D	0 121	0.04 (4)
C-D	-2799 0	-91.8	-91.8 0.32 (1)	3.88	D-P	0 1267	0.23 (1)
D-E	-3509 0	-91.8	-91.8 0.95 (1)	2.94	P-E	-843 0	0.25 (1)
E-F	-3507 0	-91.8	-91.8 0.93 (1)	2.94	E-O	-2 0	0.00 (1)
F-G	-3507 0	-91.8	-91.8 0.93 (1)	2.94	O-G	-843 0	0.25 (1)
G-H	-3507 0	-91.8	-91.8 0.94 (1)	2.95	O-H	0 1266	0.28 (1)
H-I	-2799 0	-91.8	-91.8 0.32 (1)	3.88	M-H	0 121	0.04 (4)
I-J	0 15	-91.8	-91.8 0.20 (1)	10.00	M-I	0 93	0.03 (4)
J-K	0 28	-91.8	-91.8 0.12 (1)	10.00	S-C	-2974 0	0.83 (1)
S-B	-270 0	0.0	0.0 0.03 (1)	7.81	I-L	-2974 0	0.83 (1)
L-J	-270 0	0.0	0.0 0.03 (1)	7.81			
S-R	0 2417	-18.5	-18.5 0.53 (1)	10.00			
R-O	0 2489	-18.5	-18.5 0.54 (1)	10.00			
Q-P	0 2489	-18.5	-18.5 0.54 (1)	10.00			
P-O	0 3509	-18.5	-18.5 0.64 (1)	10.00			
O-N	0 2489	-18.5	-18.5 0.54 (1)	10.00			
N-M	0 2489	-18.5	-18.5 0.54 (1)	10.00			
M-L	0 2417	-18.5	-18.5 0.53 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

156 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.41")

CSK: TC=0.95; 1.00 (D-E:1), BC=0.64; 1.00 (O-P:1), WB=0.83; 1.00 (I-L:1), SS=0.28; 1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.89 (L) (INPUT = 0.90)
JSI METAL= 0.77 (IN) (INPUT = 1.00)



Structural component only
DWG# T-2007662

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T42	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 0.310 S Oct 29 2019 Mtek Industries, Inc. Tue Apr 28 10:20:01 2020 Page 1
 ID:DMCubINVR8TsIFoe31v6l_2ns1H-LdWnxHEglAQpGfSAHixTnp8U9V?RfJlQ??En3zME7
 35-24 38-5-8 1-3-8
 Scale = 1:57.6

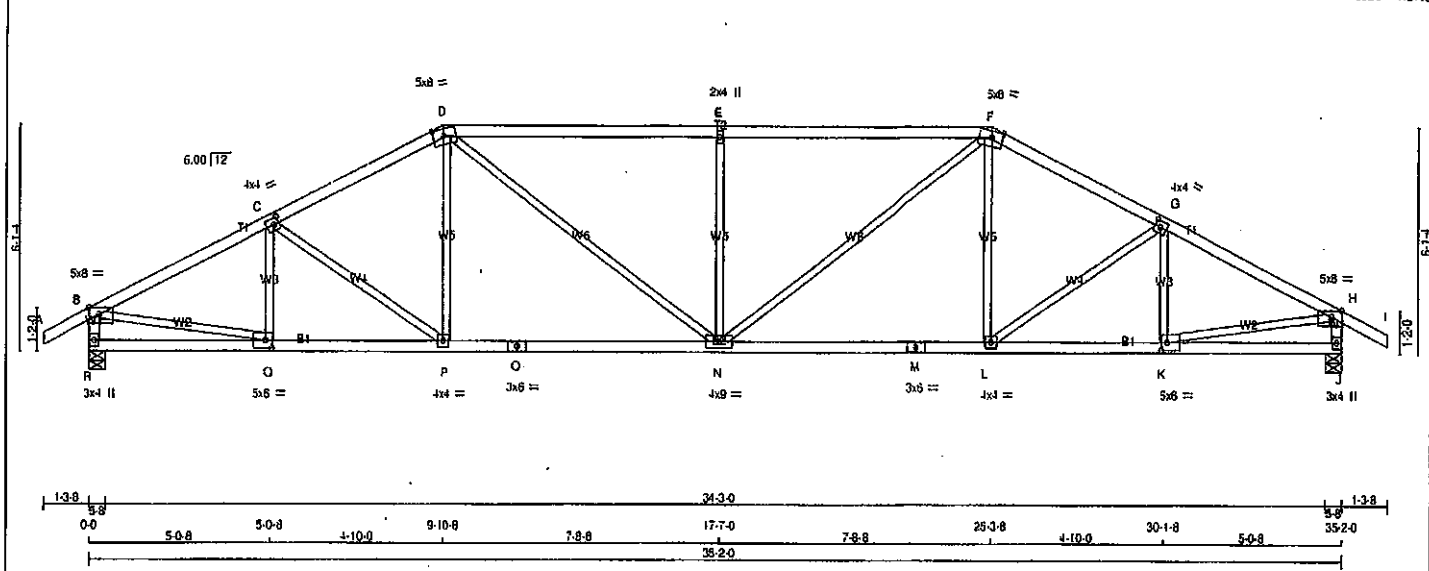

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - I	2x4	DRY	No.2	SPF	
I - B	2x4	DRY	No.2	SPF	
B - H	2x4	DRY	No.2	SPF	
H - O	2x4	DRY	No.2	SPF	
O - M	2x4	DRY	No.2	SPF	
M - J	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMWW-p	MT20	5.0	8.0	Edge	3.50
C	TMWW-t	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	8.0	2.25	3.75
E	TMWW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	8.0	2.25	3.75
G	TMWW-t	MT20	4.0	4.0	2.00	1.75
H	TMWW-p	MT20	5.0	8.0	Edge	3.50
J	BMV1-p	MT20	3.0	4.0		
K	BMWW-t	MT20	5.0	8.0	2.50	2.00
L	BMWW-t	MT20	4.0	4.0		
M	BS-t	MT20	3.0	8.0		
N	BMWW-t	MT20	4.0	8.0		
O	BS-t	MT20	3.0	8.0		
P	BMWW-t	MT20	4.0	4.0		
Q	BMWW-t	MT20	5.0	8.0	2.50	2.00
R	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REORD BRG
JT VERT	2083 0	2083 0	5-8	5-8
R HORZ	2083 0	2083 0	5-8	5-8
J UPLIFT	2083 0	2083 0	5-8	5-8

UNFACTORED REACTIONS

1ST CASE	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
JT COMBINED	989 0	0 0	0 0	0 0	488 0	0 0
R	989 0	0 0	0 0	0 0	488 0	0 0
J	989 0	0 0	0 0	0 0	488 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.78 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADINGS

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC)	UNBRACED LENGTH	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC)
FR-TO						FR-TO		
A-B	0 28	-91.8	-91.8	0.12 (1)	10.00	Q-C	-353 0	0.08 (1)
B-C	-2834 0	-91.8	-91.8	0.39 (1)	3.81	C-P	-210 0	0.13 (1)
C-D	-2687 0	-91.8	-91.8	0.37 (1)	3.91	P-D	0 246	0.06 (4)
D-E	-3060 0	-91.8	-91.8	0.97 (1)	2.78	D-N	0 844	0.19 (1)
E-F	-3060 0	-91.8	-91.8	0.97 (1)	2.78	N-E	-872 0	0.51 (1)
F-G	-2687 0	-91.8	-91.8	0.37 (1)	3.91	N-F	0 844	0.19 (1)
G-H	-2834 0	-91.8	-91.8	0.39 (1)	3.81	L-F	0 246	0.06 (4)
H-I	0 28	-91.8	-91.8	0.12 (1)	10.00	L-G	-210 0	0.13 (1)
I-B	-2018 0	0.0	0.0	0.20 (1)	5.94	K-G	-353 0	0.08 (1)
J-H	-2018 0	0.0	0.0	0.20 (1)	5.94	B-Q	0 2591	0.58 (1)
						K-H	0 2591	0.58 (1)
R-Q	0 0	-18.5	-18.5	0.10 (4)	10.00			
Q-P	0 2555	-18.5	-18.5	0.51 (1)	10.00			
P-O	0 2388	-18.5	-18.5	0.49 (1)	10.00			
O-N	0 2388	-18.5	-18.5	0.49 (1)	10.00			
N-M	0 2388	-18.5	-18.5	0.49 (1)	10.00			
M-L	0 2388	-18.5	-18.5	0.49 (1)	10.00			
L-K	0 2555	-18.5	-18.5	0.51 (1)	10.00			
K-J	0 0	-18.5	-18.5	0.10 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.8 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.17")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.34")

CSI: TC=0.97 1.00 (D-E:1), BC=0.51 1.00 (P-Q:1), WB=0.59/1.00 (B-Q:1), SS=0.34/1.00 (D-E:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg


JSI GRIP = 0.87 (F) INPUT = 0.90
 JSI METAL = 0.75 (M) INPUT = 1.00



Structural component only
 DWG# T-2007663

JOB NAME 408224	TRUSS NAME T43	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Matek Industries, Inc. Tue Apr 28 10:20:02 2020 Page 1
 ID:DMCubINVR6TstFoe31v6I_zns11-qd498dEleUYGHO1NrQSIJ1h7BZVAQsVlknVzME7h
 23-3 29-1-3 35-2-0 38-5-8
 Scale = 1:57.6

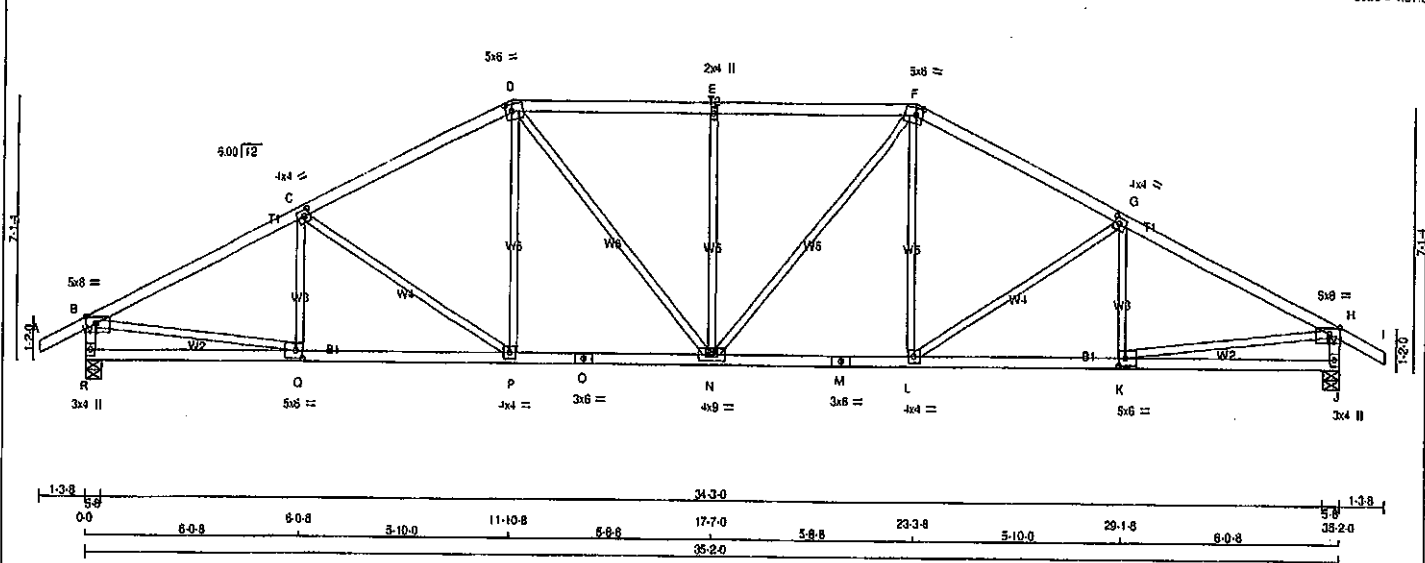

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	8.0	Edge 3.50
C	TMVW-i	MT20	4.0	4.0	2.00 1.75
O	TTWW-m	MT20	5.0	6.0	2.25 2.00
E	TMVW-w	MT20	2.0	4.0	
F	TTWW-m	MT20	5.0	8.0	2.25 2.00
G	TMVW-i	MT20	4.0	4.0	2.00 1.75
H	TMVW-p	MT20	5.0	8.0	Edge 3.50
J	BMV-i	MT20	3.0	4.0	
K	BMVW-i	MT20	5.0	8.0	2.50 2.25
L	BMVW-i	MT20	4.0	4.0	
M	BS-i	MT20	3.0	6.0	
N	BMVW-i	MT20	4.0	9.0	
O	BS-i	MT20	3.0	6.0	
P	BMVW-i	MT20	4.0	4.0	
Q	BMVW-i	MT20	5.0	8.0	2.50 2.25
R	BMV-i	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
FACTORED			MAXIMUM FACTORED		
GROSS REACTION			GROSS REACTION		
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
R	2083	0	2083	0	0
J	2083	0	2083	0	0

UNFACTORED REACTIONS					
1ST CASE			MAX. MIN. COMPONENT REACTIONS		
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
R	1457	989	0	0	0
J	1457	989	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	MAX. FACTORED	MEMB.	MAX. FACTORED	FACTORED	MAX. FACTORED
	FORCE (LBS)	VERT. LOAD (LBS)	MAX. CS (LBS)		FORCE (LBS)	MAX. CS (LBS)	
FR-TO		FROM TO	LENGTH	FR-TO		FROM TO	LENGTH
A-B	0 28	-91.8	-91.8 0.12 (1)	10.00	Q-C	-255 12	0.07 (1)
B-C	-2889 0	-91.8	-91.8 0.58 (1)	3.58	Q-P	-435 0	0.42 (1)
C-D	-2539 0	-91.8	-91.8 0.82 (1)	3.83	P-D	0 350	0.08 (1)
D-E	-2559 0	-91.8	-91.8 0.48 (1)	3.65	D-N	0 462	0.11 (1)
E-F	-2559 0	-91.8	-91.8 0.48 (1)	3.65	N-E	-841 0	0.56 (1)
F-G	-2539 0	-91.8	-91.8 0.52 (1)	3.83	N-F	0 482	0.11 (1)
G-H	-2889 0	-91.8	-91.8 0.58 (1)	3.58	L-F	0 350	0.08 (1)
H-I	0 28	-91.8	-91.8 0.12 (1)	10.00	L-G	-435 0	0.42 (1)
R-B	-2014 0	0.0	0.0 0.20 (1)	5.95	K-G	-255 12	0.07 (1)
J-H	-2014 0	0.0	0.0 0.20 (1)	5.95	B-O	0 2635	0.59 (1)
R-O	0 0	-18.5	-18.5 0.15 (4)	10.00	K-H	0 2635	0.59 (1)
Q-P	0 2809	-18.5	-18.5 0.49 (1)	10.00			
P-O	0 2249	-18.5	-18.5 0.43 (1)	10.00			
O-N	0 2249	-18.5	-18.5 0.43 (1)	10.00			
N-M	0 2249	-18.5	-18.5 0.43 (1)	10.00			
M-L	0 2249	-18.5	-18.5 0.43 (1)	10.00			
L-K	0 2809	-18.5	-18.5 0.49 (1)	10.00			
K-J	0 0	-18.5	-18.5 0.15 (4)	10.00			

TOTAL WEIGHT = 2 X 145 = 289 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 OL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 OL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C

LOADING IN PLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.15")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.28")

CS: TC=0.58/1.00 (H-H:1), SC=0.49/1.00 (K-L:1), WB=0.59/1.00 (H-K:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (Q) INPUT = 0.90
 JSI METAL = 0.69 (M) INPUT = 1.00



Structural component only
 DWG# T-2007664

S-R		0	0	-18.5	-18.5	0.20 (4)	10.00
R-O		0	2630	-18.5	-18.5	0.52 (1)	10.00
O-P		0	2630	-18.5	-18.5	0.52 (1)	10.00
P-O		0	2183	-18.5	-18.5	0.45 (1)	10.00
Q-M		0	2630	-18.5	-18.5	0.52 (1)	10.00
N-M		0	2630	-18.5	-18.5	0.52 (1)	10.00
M-L		0	0	-18.5	-18.5	0.20 (4)	10.00
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 788 1987 1658 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP = 0.88 (M) (INPUT = 0.90) JSI METAL = 0.79 (Q) (INPUT = 1.00)							

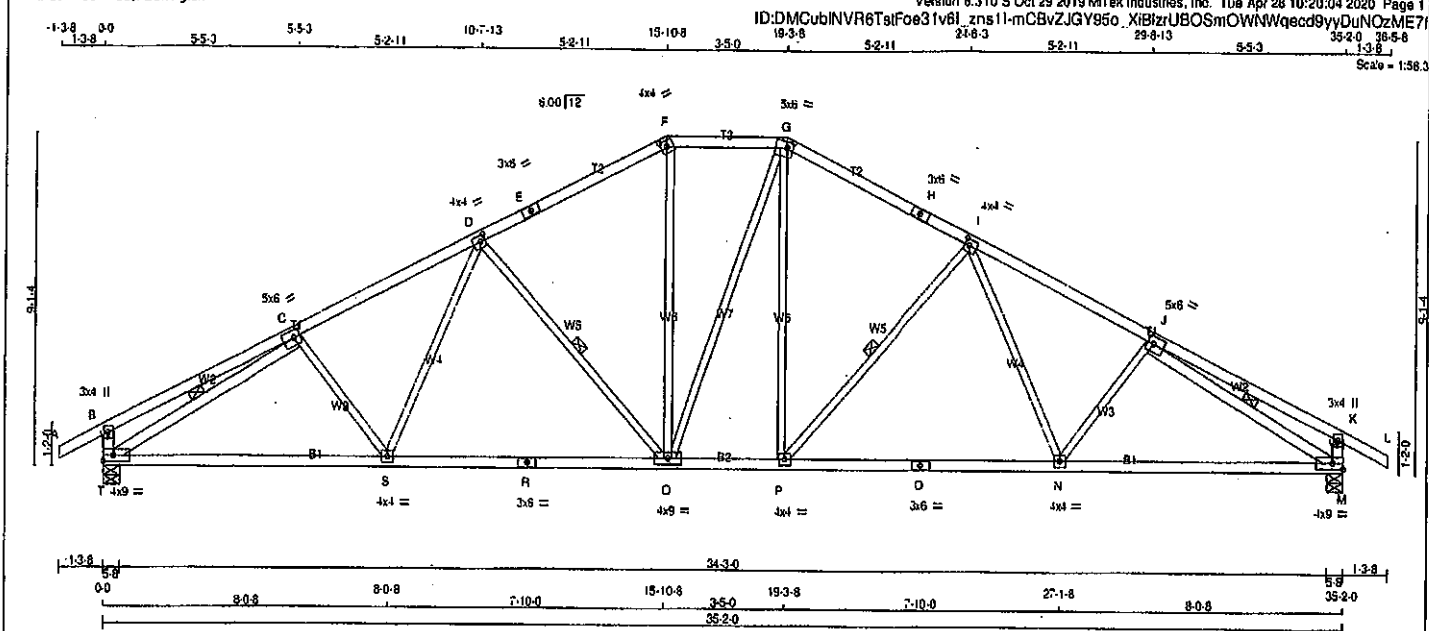

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - E	2x4	DRY No.2	SPF
F - G	2x4	DRY No.2	SPF
G - H	2x4	DRY No.2	SPF
H - L	2x4	DRY No.2	SPF
T - B	2x4	DRY No.2	SPF
M - K	2x4	DRY No.2	SPF
T - R	2x4	DRY No.2	SPF
R - O	2x4	DRY No.2	SPF
O - M	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF
T - C	2x4	DRY No.2	SPF
J - M	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+P	MT20	3.0	4.0		
C	TMWW-I	MT20	5.0	6.0	2.50	2.25
D	TMWW-I	MT20	4.0	4.0	2.00	1.50
E	TS-I	MT20	3.0	8.0		
F	TTW-h	MT20	4.0	4.0	2.00	1.75
G	TTWW-m	MT20	5.0	8.0	2.00	2.00
H	TS-I	MT20	3.0	8.0		
I	TMWW-I	MT20	4.0	4.0	2.00	1.50
J	TMWW-I	MT20	5.0	6.0	2.50	2.25
K	TMV+P	MT20	3.0	4.0		
M	BMVW1-I	MT20	4.0	9.0		Edge
N, P, S						
N	BMWW-I	MT20	4.0	4.0		
O	BS-I	MT20	3.0	6.0		
Q	BMWWWW-I	MT20	4.0	9.0		
R	BS-I	MT20	3.0	6.0		
T	BMVW1-I	MT20	4.0	9.0		Edge

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER						
BEARINGS						
JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORIZ	DOWN	HORIZ	IN-SX	IN-SX
T	2063	0	2063	0	5-8	5-8
M	2063	0	2063	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SC
T	1457	989 0	0 0	0 0	0 0	486 0	0
M	1457	969 0	0 0	0 0	0 0	488 0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T. M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.86 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF D-Q, I-P, C-T, J-M

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: 14)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		WEBS	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 28	-91.8	-91.8 0.12 (1)	10.00	C-S	-110 37	0.04 (1)
B-C	0 20	-91.8	-91.8 0.32 (1)	10.00	S-D	0 276	0.08 (1)
C-D	-2760 0	-91.8	-91.8 0.40 (1)	3.86	D-Q	-892 0	0.31 (1)
D-E	-2187 0	-91.8	-91.8 0.38 (1)	4.30	Q-F	0 614	0.14 (1)
E-F	-2187 0	-91.8	-91.8 0.38 (1)	4.30	Q-G	0 4	0.00 (1)
F-G	-1925 0	-91.8	-91.8 0.18 (1)	4.71	P-G	0 609	0.14 (1)
G-H	-2185 0	-91.8	-91.8 0.38 (1)	4.30	P-I	-683 0	0.31 (1)
H-I	-2185 0	-91.8	-91.8 0.36 (1)	4.30	I-N	0 279	0.06 (1)
I-J	-2761 0	-91.8	-91.8 0.40 (1)	3.86	N-J	-110 37	0.04 (1)
J-K	0 20	-91.8	-91.8 0.32 (1)	10.00	T-C	-3042 0	0.81 (1)
K-L	0 28	-91.8	-91.8 0.12 (1)	10.00	J-M	-3043 0	0.81 (1)
T-B	-325 0	0.0	0.0 0.03 (1)	7.81			
M-K	-325 0	0.0	0.0 0.03 (1)	7.81			

T-S	0 2537	-18.5	-18.5	0.58 (1)	10.00
S-R	0 2383	-18.5	-18.5	0.53 (1)	10.00
R-Q	0 2393	-18.5	-18.5	0.53 (1)	10.00
Q-P	0 1924	-18.5	-18.5	0.40 (1)	10.00
P-O	0 2382	-18.5	-18.5	0.53 (1)	10.00
O-N	0 2362	-18.5	-18.5	0.53 (1)	10.00
N-M	0 2538	-18.5	-18.5	0.58 (1)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:				
TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF 8CBC 2018 , OBC 2012 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENOMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF
LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/380 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.29")

CSI: TC=0.40/1.00 (I-J:1), BC=0.58/1.00 (M-N:1),
WB=0.61/1.00 (J-M:1), SSI=0.20/1.00 (G-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIPIDRY (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1858

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg

JSI GRIP = 0.89 (F) ; INPUT = 0.90 ;
JSI METAL = 0.83 (O) ; INPUT = 1.00



Structural component only
DWG# T-2007666

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T46	8	1	GREEN PARK HOMES	
JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
Tamarack Roof Truss, Burlington	T46	8	1	TRUSS DESC.	

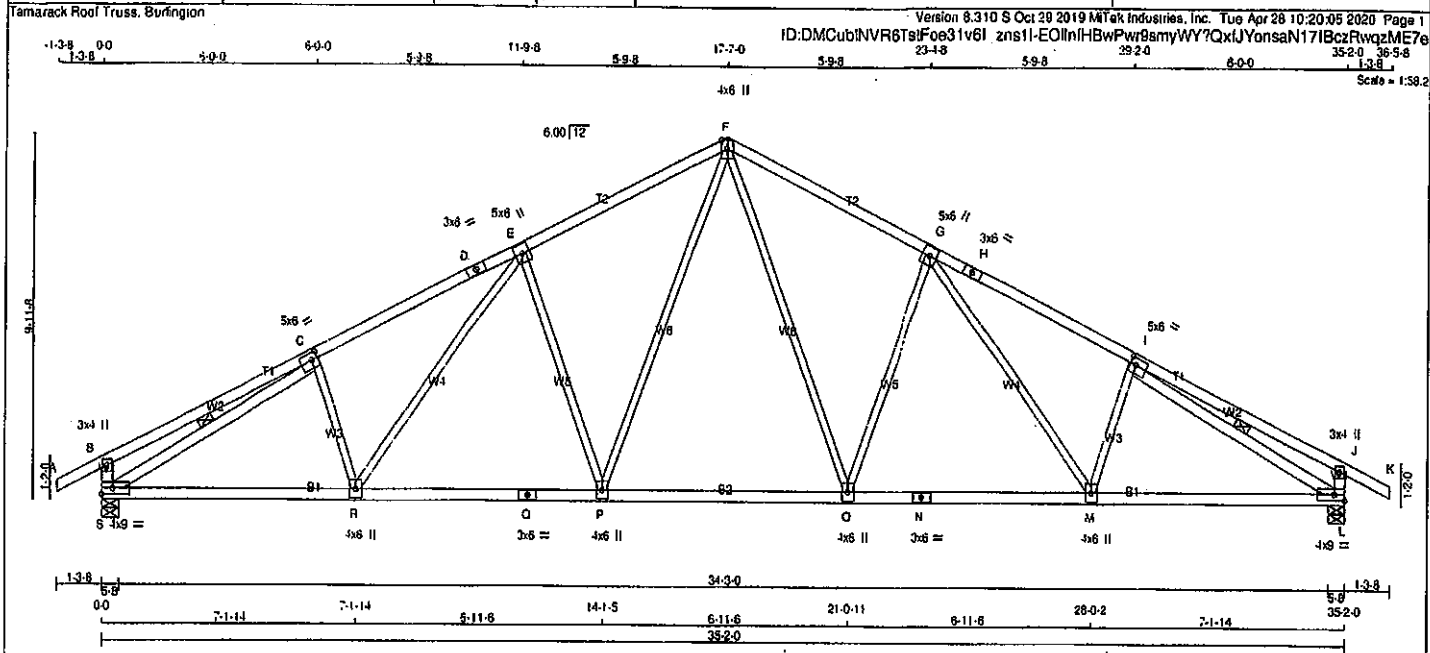

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD	SPECIFIED LOADS:	
A - D	2x4	DRY	No.2	SPF	FACTORED	GROSS REACTION	GROSS REACTION	BRG	BRG	TOP CH. LL =	25.6 PSF
D - F	2x4	DRY	No.2	SPF	JT	VERT	DOWN	UP	IN-SX	DL =	6.0 PSF
F - H	2x4	DRY	No.2	SPF	S	2063	0	0	5-8	BOY CH. LL =	0.0 PSF
H - K	2x4	DRY	No.2	SPF	L	2063	0	0	5-8	DL =	7.4 PSF
S - B	2x4	DRY	No.2	SPF						TOTAL LOAD =	39.0 PSF
L - J	2x4	DRY	No.2	SPF						SPACING =	24.0 IN. C/C
S - Q	2x4	DRY	No.2	SPF							
Q - N	2x4	DRY	No.2	SPF							
N - L	2x4	DRY	No.2	SPF							
ALL WEBS	2x3	DRY	No.2	SPF							
EXCEPT											
S - C	2x4	DRY	No.2	SPF							
I - L	2x4	DRY	No.2	SPF							

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
A - B	MT20	3.0	4.0		
B - C	MT20	5.0	6.0	2.25	2.00
C - D	MT20	3.0	6.0		
D - E	MT20	5.0	6.0		
E - F	MT20	4.0	6.0	Edge	
F - G	MT20	5.0	6.0		
G - H	MT20	3.0	6.0		
H - I	MT20	5.0	6.0	2.25	2.00
I - J	MT20	3.0	4.0		
J - K	MT20	4.0	9.0	Edge	
M, O, P, R					
M - N	MT20	4.0	6.0		
N - O	MT20	3.0	6.0		
O - P	MT20	3.0	6.0		
P - Q	MT20	4.0	9.0	Edge	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-S, I-L
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM TO		FR-TO			
A-B	0 28	-91.8 -91.8 0.12 (1)	10.00	F-O	0 866	0.19 (1)	
B-C	0 22	-91.8 -91.8 0.40 (1)	10.00	O-G	-726 0	0.72 (1)	
C-D	-2808 0	-91.8 -91.8 0.49 (1)	3.75	G-M	0 391	0.09 (1)	
D-E	-2808 0	-91.8 -91.8 0.49 (1)	3.75	M-I	-192 18	0.05 (1)	
E-F	-2322 0	-91.8 -91.8 0.46 (1)	4.07	P-F	0 866	0.19 (1)	
F-G	-2322 0	-91.8 -91.8 0.48 (1)	4.07	E-P	-726 0	0.72 (1)	
G-H	-2808 0	-91.8 -91.8 0.49 (1)	3.75	R-E	0 391	0.09 (1)	
H-I	-2808 0	-91.8 -91.8 0.49 (1)	3.75	C-R	-192 18	0.05 (1)	
I-J	0 22	-91.8 -91.8 0.40 (1)	10.00	S-C	-3064 0	0.72 (1)	
J-K	0 28	-91.8 -91.8 0.12 (1)	10.00	I-L	-3064 0	0.72 (1)	
S-B	-344 0	0.0 0.0 0.03 (1)	7.81				
L-J	-344 0	0.0 0.0 0.03 (1)	7.81				
S-R	0 2574	-18.5 -18.5 0.53 (1)	10.00				
R-O	0 2291	-18.5 -18.5 0.47 (1)	10.00				
O-P	0 2291	-18.5 -18.5 0.47 (1)	10.00				
P-Q	0 1762	-18.5 -18.5 0.38 (1)	10.00				
Q-N	0 2291	-18.5 -18.5 0.47 (1)	10.00				
N-M	0 2291	-18.5 -18.5 0.47 (1)	10.00				
M-L	0 2574	-18.5 -18.5 0.53 (1)	10.00				

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.28")

CS: TC=0.39/1.00 (C-E:1), BC=0.53/1.00 (L-M:1), WB=0.72/1.00 (E-P:1), SS=0.22/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION	(PSI)	(PLI)
MT20	618	354	1887	788	1987

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.87 (C) (INPUT = 0.90)
JSI METAL= 0.77 (I) (INPUT = 1.00)

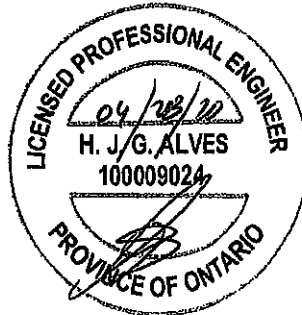

Structural component only
DWG# T-2007667

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T47S	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 3.310 S Oct 29 2019 M Tek Industries, Inc. Tue Apr 28 10:20:06 2020 Page 1
ID:DMCubINVR6TsFoe31v6I zns11-bJg.7Hphj2im0K84GWttsngADw8c_RQGi_SGzME7d

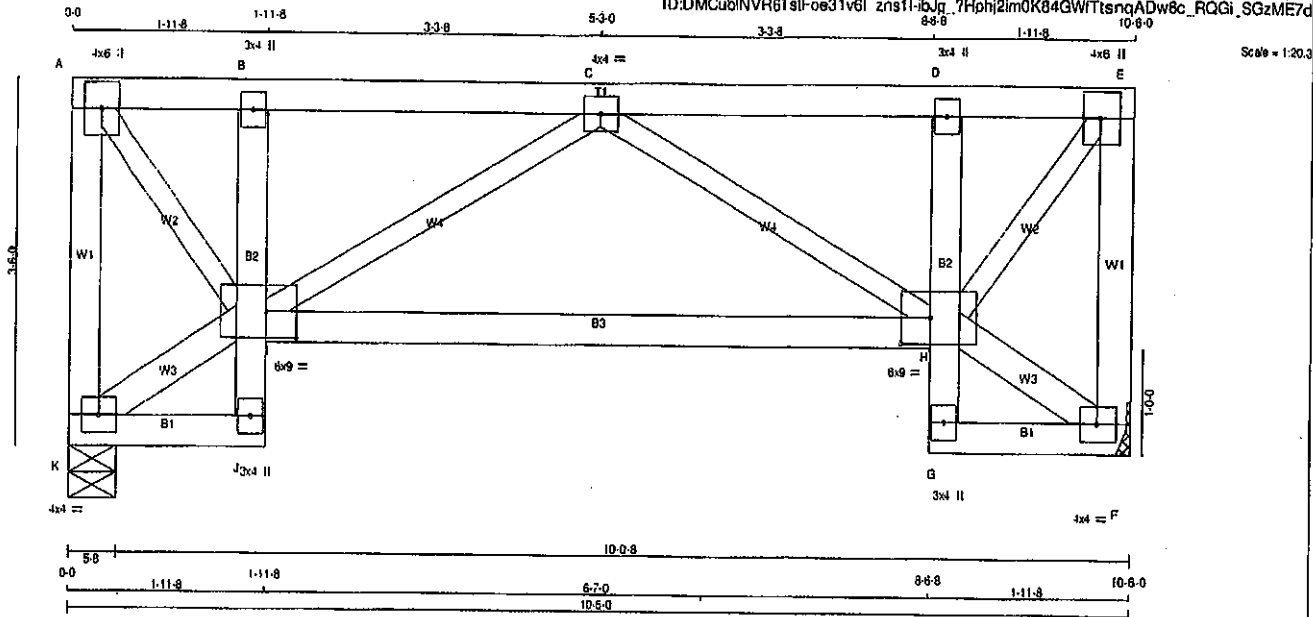

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
K - A	2x4	DRY	No. 2	SPF	
A - E	2x4	DRY	No. 2	SPF	
F - E	2x4	DRY	No. 2	SPF	
K - J	2x4	DRY	No. 2	SPF	
J - B	2x4	DRY	No. 2	SPF	
I - H	2x4	DRY	No. 2	SPF	
G - D	2x4	DRY	No. 2	SPF	
G - F	2x4	DRY	No. 2	SPF	
ALL WEBS	2x3	DRY	No. 2	SPF	
EXCEPT					
K - I	2x4	DRY	No. 2	SPF	
H - F	2x4	DRY	No. 2	SPF	

DRY, SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	6.0		
B	TMV+p	MT20	3.0	4.0		
C	TMVW-I	MT20	4.0	4.0		
D	TMV+p	MT20	3.0	4.0		
E	TMVW+p	MT20	4.0	6.0		
F	BMVW-I	MT20	4.0	4.0		
G	BMV+p	MT20	3.0	4.0		
H	BVMW-W-I	MT20	6.0	9.0	3.00	3.50
I	BVMW-W-I	MT20	6.0	9.0	3.00	3.50
J	BMV+p	MT20	3.0	4.0		
K	BMVW-I	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING

FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	HORZ	DOWN	HORZ
K 697	0	897	0
F 697	0	897	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT COMBINED							
K 504	269	0	0	0	0	235	0
F 504	269	0	0	0	0	235	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	FACTORED	MAX.
MAX. FORCE	FORCE	VERT.	LOAD	LC1	MAX	MAX.	MEMB.	FACTORED	MAX.
(LBS)	(LBS)	(LBS)	(LBS)	(LBS)	(LBS)	(LBS)	(LBS)	(LBS)	(LBS)
FR-TO	FROM	TO	FROM	TO	FROM	TO	FR-TO	FROM	TO
K-A	-667	0	0.0	0.0	0.17 (1)	7.81	K-I	-28	0
A-B	-497	0	-114.3	-114.3	0.14 (1)	8.25	A-I	0	783
B-C	-508	0	-114.3	-114.3	0.22 (1)	8.25	H-F	-28	0
C-D	-508	0	-114.3	-114.3	0.22 (1)	8.25	H-E	0	783
D-E	-497	0	-114.3	-114.3	0.14 (1)	8.25	I-C	-384	0
E-F	-667	0	0.0	0.0	0.17 (1)	7.81	C-H	-384	0
K-J	0	25	-18.5	-18.5	0.03 (4)	10.00			
J-I	0	19	0.0	0.0	0.05 (1)	10.00			
I-B	-331	0	0.0	0.0	0.05 (1)	7.81			
I-H	0	832	-18.5	-18.5	0.46 (4)	10.00			
G-H	0	19	0.0	0.0	0.05 (1)	10.00			
H-D	-331	0	0.0	0.0	0.05 (1)	7.81			
G-F	0	25	-18.5	-18.5	0.03 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 15.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 48.0 PSF

SPACING = 24.0 IN./G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 688-09, CSA 688-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.22/1.00 (B-C:1), BC=0.46/1.00 (H-I:4),
WB=0.24/1.00 (E-H:1), SSI=0.22/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.77 (H) INPUT = 0.90
JSI METAL = 0.30 (E) INPUT = 1.00



Structural component only
DWG# T-2007668

JOB NAME 408224	TRUSS NAME T48	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

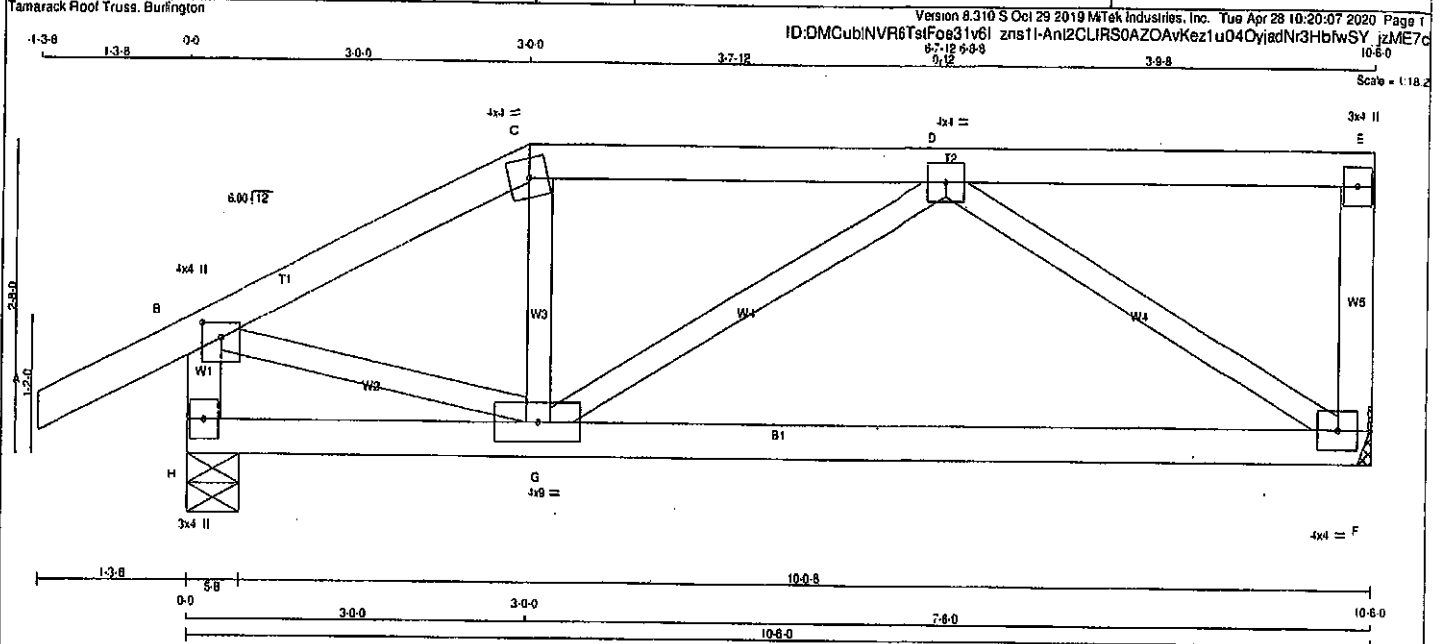

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
F - E	2x4	DRY	No.2	SPF
H - B	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMW+p	MT20	4.0	4.0	1.50 2.00
C	TTW-m	MT20	4.0	4.0	
D	TMWV-l	MT20	4.0	4.0	
E	TMV+p	MT20	3.0	4.0	
F	BMWV1-l	MT20	4.0	4.0	
G	BMWVW-l	MT20	4.0	9.0	
H	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	JT DOWN	IN-SX	IN-SX
F 579 0	579 0	MECHANICAL	
H 703 0	703 0	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1'-0".

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
F 409 269 0 0 0 0 0 0 0 0	
H 495 338 0 0 0 0 0 0 0 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 28	-91.8 -91.8 0.12 (1)	10.00	G-C	0 81	0.02 (4)	
B-C	-835 0	-91.8 -91.8 0.15 (1)	6.25	G-D	-61 60	0.02 (4)	
C-D	-589 0	-91.8 -91.8 0.21 (1)	6.25	D-F	-731 0	0.23 (1)	
D-E	0 0	-91.8 -91.8 0.20 (1)	10.00	B-G	0 587	0.13 (1)	
E-F	-135 0	0.0 0.0 0.02 (1)	7.81				
H-B	-699 0	0.0 0.0 0.07 (1)	7.81				
H-G	0 0	-18.5 -18.5 0.21 (4)	10.00				
G-F	0 819	-18.5 -18.5 0.25 (4)	10.00				

TOTAL WEIGHT = 40 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L 999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L 999 (0.09")

CSI: TC=0.21-1.00 (C-D:1) . 8C=0.25-1.00 (F-G:4) .
WB=0.23-1.00 (D-F:1) . SSI=0.17-1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618 354 1687 788 1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.68 (B) (INPUT = 0.90)
JSI METAL = 0.23 (F) (INPUT = 1.00)



Structural component only
DWG# T-2007669

JOB NAME 408224	TRUSS NAME T49	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Tue Apr 26 10:20:08 2020 Page 1
ID:DMCubINVR6TslFos31v6L_2ns1l-ezRQPhJ3DKIQ0JUWCqZ7ZlX3M_zfaUMktaB5W9zME7b

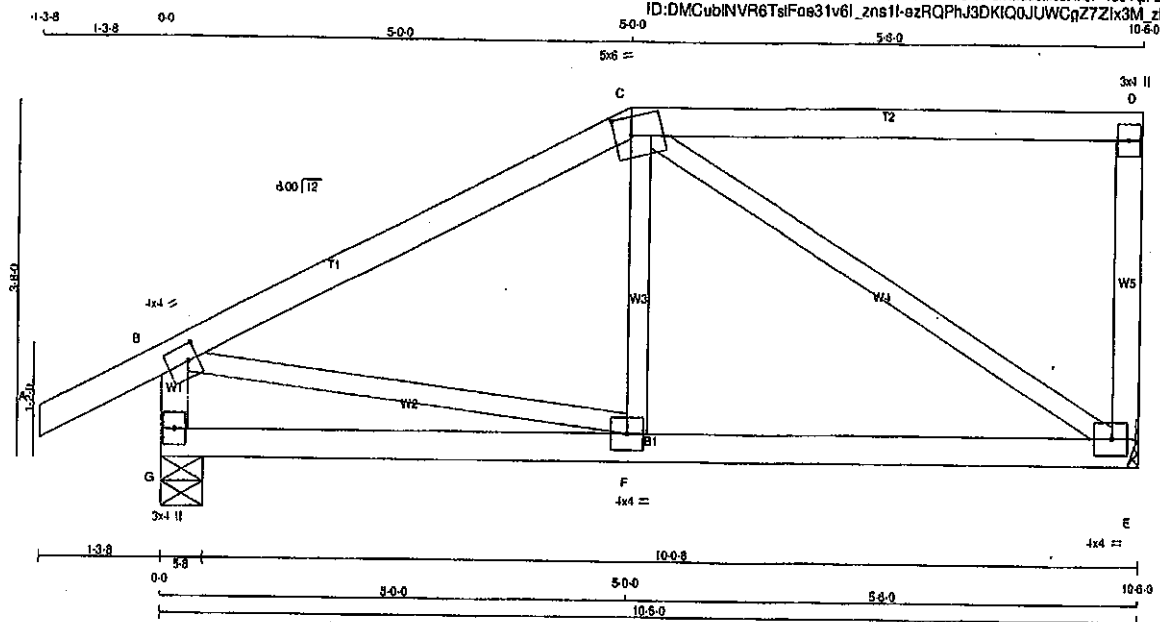

Scale = 1:22.0

LUMBER			
N.L.G.A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
E - D	2x4	DRY	No.2
G - B	2x4	DRY	No.2
G - E	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	4.0	4.0	2.00 1.25
C	TTWW-m	MT20	5.0	6.0	2.25 2.00
D	TMV-p	MT20	3.0	4.0	
E	BMVW1-t	MT20	4.0	4.0	
F	BMVW-t	MT20	4.0	4.0	
G	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
E	579	0	579	0	0
G	703	0	703	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1'-8".

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
E	409	269 0	0 0	0 0	141 0	0 0
G	495	338 0	0 0	0 0	157 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 28	-91.8 -91.8	0.12 (1)	10.00	F-C	0 106	0.04 (4)
B-C	-523 0	-91.8 -91.8	0.41 (1)	6.25	C-E	-549 0	0.37 (1)
C-D	0 0	-91.8 -91.8	0.47 (1)	10.00	B-F	0 474	0.11 (1)
E-D	-252 0	0.0 0.0	0.05 (1)	7.81			
G-B	-887 0	0.0 0.0	0.07 (1)	7.81			
G-F	0 0	-18.5 -18.5	0.14 (4)	10.00			
F-E	0 468	-18.5 -18.5	0.19 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.35")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.35")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSI: TC=0.47 1.00 (C-D:1), BC=0.19/1.00 (E-F:4), WB=0.37 1.00 (C-E:1), SS=0.20/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PLI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (B) (INPUT = 0.90)
JSI METAL = 0.26 (B) (INPUT = 1.00)

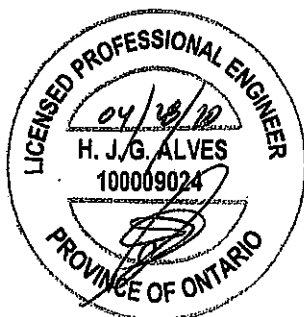


Structural component only
DWG# T-2007670

Italy **Industria**

Scale = 1:100




JSI GRIP = 0.25 (A) (INPUT = 0.90)
JSI METAL = 0.07 (A) (INPUT = 1.00)



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	G50	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Tamarack Roof Truss, Burlington

Version 3.310 S Oct 29 2019 MTak Industries, Inc. Tue Apr 28 10:19:51 2020 Page 1
ID:DMCubINVR8TstFoe31v6l zns11-eiv?ri8OD69qTihFic7MikFo7CC512EzRaiQozME7s

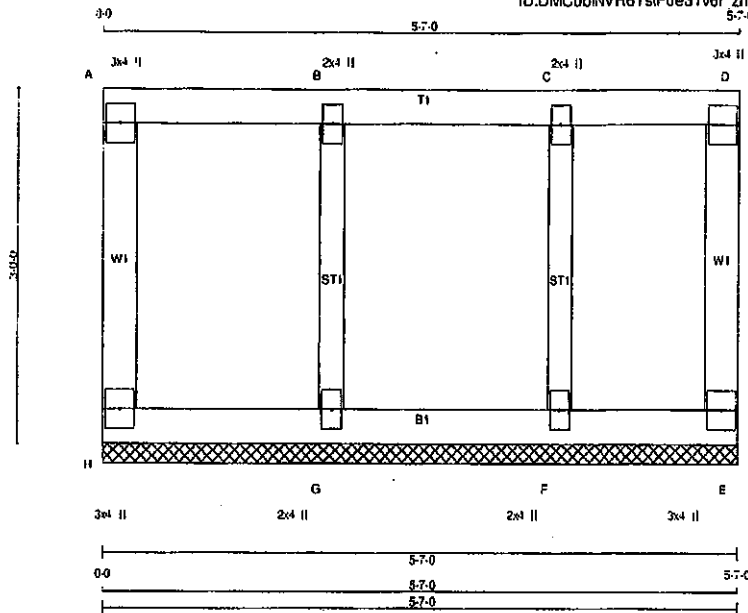

TOTAL WEIGHT = 22 k (M/R)

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
H - A	2x4	DRY	No 2
A - D	2x4	DRY	No 2
E - D	2x4	DRY	No 2
H - E	2x4	DRY	No 2

ALL WEBS 2x3 DRY No 2
ALL GABLE WEBS 2x3 DRY No 2
DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2-0-0 OC.

DESCR.

SPF
SPF
SPF
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING.

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO					FR-TO		
H-A	-101 0	0.0	0.03 (1)	7.81	G-B	-248 0	0.08 (1)
A-B	-8 0	-114.3	0.08 (1)	10.00	F-C	-209 0	0.05 (1)
B-C	-8 0	-114.3	0.08 (1)	10.00			
C-D	-8 0	-114.3	0.08 (1)	10.00			
E-D	-80 0	0.0	0.03 (1)	7.81			
H-G	0 8	-18.5	-18.5 0.02 (4)	10.00			
G-F	0 8	-18.5	-18.5 0.02 (4)	10.00			
F-E	0 8	-18.5	-18.5 0.02 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 15.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 48.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OF SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.00/1.00 (A-B:1), BC=0.02/1.00 (G-H:4), WB=0.06/1.00 (B-G:1), ST=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.60 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.17 (G) INPUT = 0.90
JSI METAL = 0.07 (G) INPUT = 1.00

PLATES (Tables in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B	TMW+w	MT20	2.0	4.0		
C	TMW+w	MT20	2.0	4.0		
D	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		
F	BMW1+w	MT20	2.0	4.0		
G	BMV1+w	MT20	2.0	4.0		
H	BMV1+p	MT20	3.0	4.0		



Structural component only
DWG# T-2007656



TOTAL WEIGHT = 44 lb

DRY: SEASONED LUMBER.

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

BUILDING BEARINGS

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3.8

UNFACTORED REACTIONS

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 1

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.22 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0 28	-91.8	-91.8 0.13 (1)	10.00	H-C	-99 54	0.02 (1)
B-C	-1177 0	-91.8	-91.8 0.48 (1)	5.22	H-D	0 30	0.01 (4)
C-D	-1045 0	-91.8	-91.8 0.03 (1)	6.11	G-D	-120 24	0.03 (1)
D-E	-1187 0	-91.8	-91.8 0.41 (1)	5.32	B-H	0 1067	0.26 (1)
I-B	-1053 0	0.0	0.0 0.12 (1)	7.64	G-E	0 1066	0.26 (1)
F-E	-953 0	0.0	0.0 0.11 (1)	7.81			
I-J	0 0	-18.5	-18.5 0.19 (4)	10.00			
J-K	0 0	-18.5	-18.5 0.19 (4)	10.00			
K-H	0 0	-18.5	-18.5 0.19 (4)	10.00			
H-G	0 1039	-18.5	-18.5 0.28 (4)	10.00			
G-L	0 0	-18.5	-18.5 0.19 (4)	10.00			
L-M	0 0	-18.5	-18.5 0.16 (4)	10.00			
M-F	0 0	-18.5	-18.5 0.16 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-10-8	-3B1	-3B1	---	FRONT	VERT	TOTAL	---	C1
D	5-9-8	-3B1	-3B1	---	FRONT	VERT	TOTAL	---	C1
G	5-8-12	-19	-19	---	FRONT	VERT	TOTAL	---	C1
H	4-11-4	-19	-19	---	FRONT	VERT	TOTAL	---	C1
K	1-11-14	-17	-18	---	FRONT	VERT	TOTAL	---	C1
M	3-11-1	-19	-19	---	FRONT	VERT	TOTAL	---	C1
L	6-8-12	-19	-19	---	FRONT	VERT	TOTAL	---	C1
M	8-8-12	-17	-18	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1. C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 688-09, CSA 688-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF
LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/988 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/988 (0.05")

CSI: TC=0.46/1.00 (B-C:1), BC=0.28/1.00 (G-H:4)
WB=0.26/1.00 (B-H:1), SS=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)	(PSI)	(PLI)	(PLI)	(PLI)	(PLI)
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	364	1867	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GR(P= 0.71 (G) (INPUT = 0.90)
JSI METAL= 0.33 (B) (INPUT = 1.00)

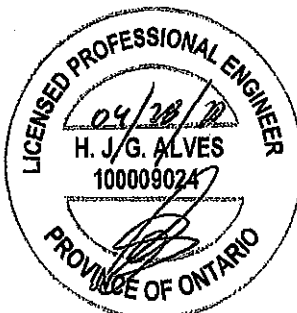


Structural component only
DWG# T-2007672

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	T52	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 3.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 16:20:12 2020 Page 1

ID:DMCubINVR6TsIFor31v6I_zns1I-XlpxF2MaHZpsUxolRWd3I86qEbM8WMgKoc9JwzME7X

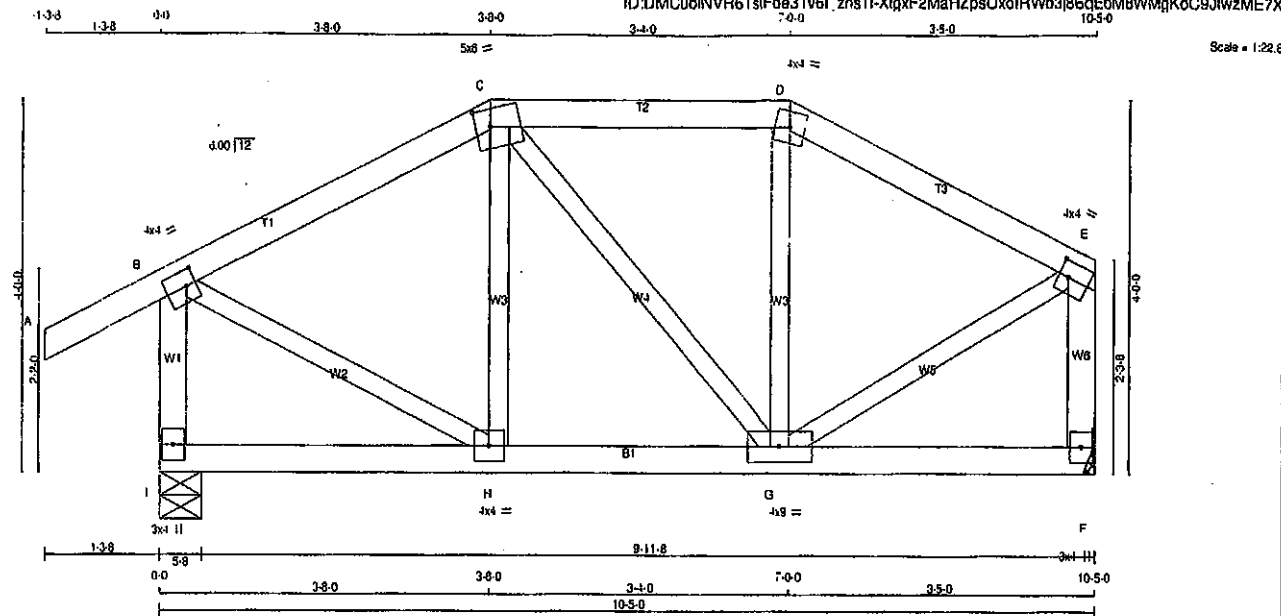

Scale = 1:22.8

TOTAL WEIGHT = 48 lb
[M][F]

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	FACTORED
C - D	2x4	DRY	No.2	SPF	GROSS REACTION
D - E	2x4	DRY	No.2	SPF	MAXIMUM FACTORED
E - F	2x4	DRY	No.2	SPF	INPUT
F - G	2x4	DRY	No.2	SPF	RECORD
G - H	2x4	DRY	No.2	SPF	BRG
H - I	2x4	DRY	No.2	SPF	IN-SX
I - J	2x4	DRY	No.2	SPF	IN-SX
ALL WEBS	2x3	DRY	No.2	SPF	MECHANICAL
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMW-t	MT20	4.0	4.0	2.00	1.25
C	TTW-m	MT20	5.0	6.0	2.25	2.00
D	TTW-m	MT20	4.0	4.0		
E	TMW-t	MT20	4.0	4.0	2.00	1.25
F	BMV1+p	MT20	3.0	4.0		
G	BMW1+p	MT20	4.0	9.0		
H	BMW1+p	MT20	4.0	4.0		
I	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	VERT	HORIZ	DOWN	HORIZ
I	699	0	699	0
F	574	0	574	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	492	338	0	0	0	0	156	0
F	406	267	0	0	0	0	140	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)	MAX. FACTORED VERT. LOAD (LC3)	MAX. FACTORED VERT. LOAD (LC4)	MAX. FACTORED VERT. LOAD (LC5)	MAX. FACTORED VERT. LOAD (LC6)	MAX. FACTORED VERT. LOAD (LC7)	MAX. FACTORED VERT. LOAD (LC8)	MAX. FACTORED VERT. LOAD (LC9)	MAX. FACTORED VERT. LOAD (LC10)
FR-TO													
A-B	0	28	-91.8	-91.8	0.12	(1)	10.00	H-C	-118	14	0.03	(1)	
B-C	-423	0	-91.8	-91.8	0.16	(1)	8.25	C-D	-20	0	0.01	(1)	
C-D	-362	0	-91.8	-91.8	0.13	(1)	8.25	G-D	-128	8	0.03	(1)	
D-E	-409	0	-91.8	-91.8	0.14	(1)	8.25	B-H	0	422	0.09	(1)	
E-F	-669	0	0.0	0.0	0.08	(1)	7.81	G-E	0	419	0.09	(1)	
F-G	-548	0	0.0	0.0	0.07	(1)	7.81						
I-H	0	0	-18.5	-18.5	0.05	(4)	10.00						
H-G	0	375	-18.5	-18.5	0.09	(1)	10.00						
G-F	0	0	-18.5	-18.5	0.05	(4)	10.00						

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9. NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.16 (1.00 (B-C:1), BC=0.09 (1.00 (G-H:1), WS=0.09 (1.00 (B-H:1), SS=0.12 (1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1655

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.65 (8) (INPUT = 0.90)
JSI METAL= 0.21 (8) (INPUT = 1.00)



Structural component only
DWG# T-2007673

JOB NAME 408224	TRUSS NAME T53	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:20:13 2020 Page 1			
		ID:DMCubINVR6TstFoe31v6l zns11-?xEJSONC2sxl65NU E8IGLezS7HfFT1svsCMzME7W			
		Scale = 1:10.5			

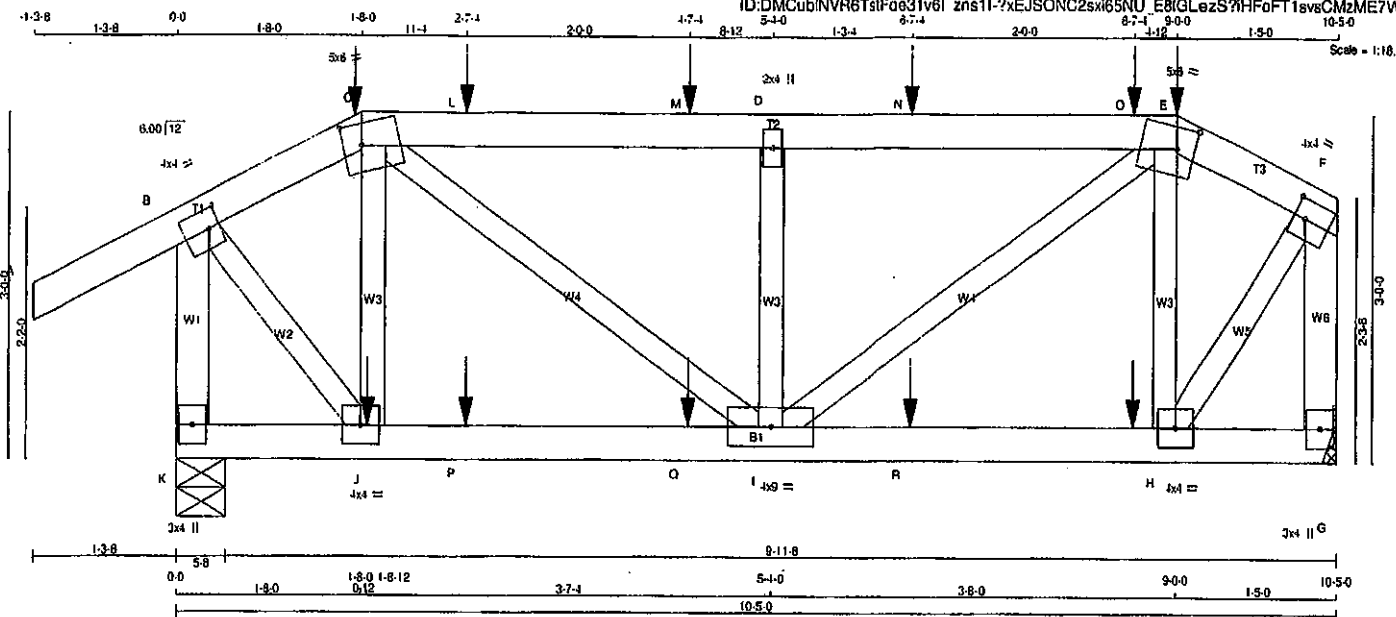

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
K - B	2x4	DRY	No.2
G - F	2x4	DRY	No.2
K - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	X
B	TMVW-1	MT20	4.0	4.0	2.00 1.25
C	TTWW-m	MT20	5.0	6.0	2.25 2.00
D	TMW-w	MT20	2.0	4.0	
E	TTWW-m	MT20	5.0	6.0	2.25 2.00
F	TMVW-1	MT20	4.0	4.0	2.00 1.25
G	BMV1-p	MT20	3.0	4.0	
H	BMVW-1	MT20	4.0	4.0	
I	BMVW-1	MT20	4.0	4.0	
J	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	UPLIFT	IN-SX
K	818	0	818	0
G	679	0	679	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 1.8.

UNFACTORED REACTIONS						
1ST CASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
K	578	393	0	0	0	183
G	480	317	0	0	0	162

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	MAX.	MEMB.	MAX. FACTORED	FACTORED	MAX.
	FORCE	VERT. LOAD	CS1 (LC)		FORCE	VERT. LOAD	CS1 (LC)
FR-TO	(LBS)	(PLF)	CS1 (LC)	FR-TO	(LBS)	(PLF)	CS1 (LC)
A-B	0	-91.8	-91.8 0.13 (1)	J-C	-307	0	0.08 (1)
B-C	-427	0	-91.8	C-I	0	438	0.11 (1)
C-L	-702	0	-91.8	I-D	-472	0	0.09 (1)
L-M	-702	0	-91.8	M-E	0	469	0.12 (1)
M-D	-702	0	-91.8	D-N	-373	0	0.07 (1)
D-N	-702	0	-91.8	N-O	0	523	0.13 (1)
N-O	-702	0	-91.8	O-E	-702	0	0.14 (1)
O-E	-702	0	-91.8	E-F	-379	0	0.10 (1)
E-F	-379	0	-91.8	F-G	-677	0	0.10 (1)
F-G	-677	0	-91.8				
K-J	0	0	-18.5				
J-P	0	349	-18.5				
P-O	0	349	-18.5				
O-Q	0	349	-18.5				
Q-I	0	324	-18.5				
I-R	0	324	-18.5				
R-H	0	324	-18.5				
H-G	0	0	-18.5				

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	1-8-0	-53	-53	-53	BACK	VERT	TOTAL	---	C1
E	9-0-0	-21	-21	-21	FRONT	VERT	TOTAL	---	C1
H	8-7-4	-4	-4	-4	BACK	VERT	TOTAL	---	C1
J	1-8-12	-4	-4	-4	BACK	VERT	TOTAL	---	C1
L	2-7-4	-28	-28	-28	BACK	VERT	TOTAL	---	C1
M	4-7-4	-25	-25	-25	BACK	VERT	TOTAL	---	C1
N	6-7-4	-25	-25	-25	BACK	VERT	TOTAL	---	C1
O	8-7-4	-53	-53	-53	BACK	VERT	TOTAL	---	C1
P	2-7-4	-4	-4	-4	BACK	VERT	TOTAL	---	C1
Q	4-7-4	-4	-4	-4	BACK	VERT	TOTAL	---	C1
R	6-7-4	-4	-4	-4	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***

GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.

LOADS WERE DERIVED FROM USER INPUT

NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019

- PART 9 OF CBC 2012 (2019 AMENDMENT)

- CSA 088-09, CSA 088-14

- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.35")

CALCULATED VERT. DEFL. (LL) = L/999 (0.01")

ALLOWABLE DEFL. (TL) = L/360 (0.35")

CALCULATED VERT. DEFL. (TL) = L/999 (0.02")

CS1: TC=0.26 (0.51), BC=0.09 (1.00) (I-J:1)

WB=0.14 (1.00) (I-H:1), SI=0.21 (1.00) (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.77 (F) (INPUT = 0.90)


JSI METAL = 0.22 (F) (INPUT = 1.00)



Structural component only
DWG# T-2007674

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T54S	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:20:14 2020 Page 1
ID:DMCubINVR6TstFoe31v6I zns11-T7ohgkOqpA3ZkEygYxqXoZB2uPsf_43dGWcKpzME7V

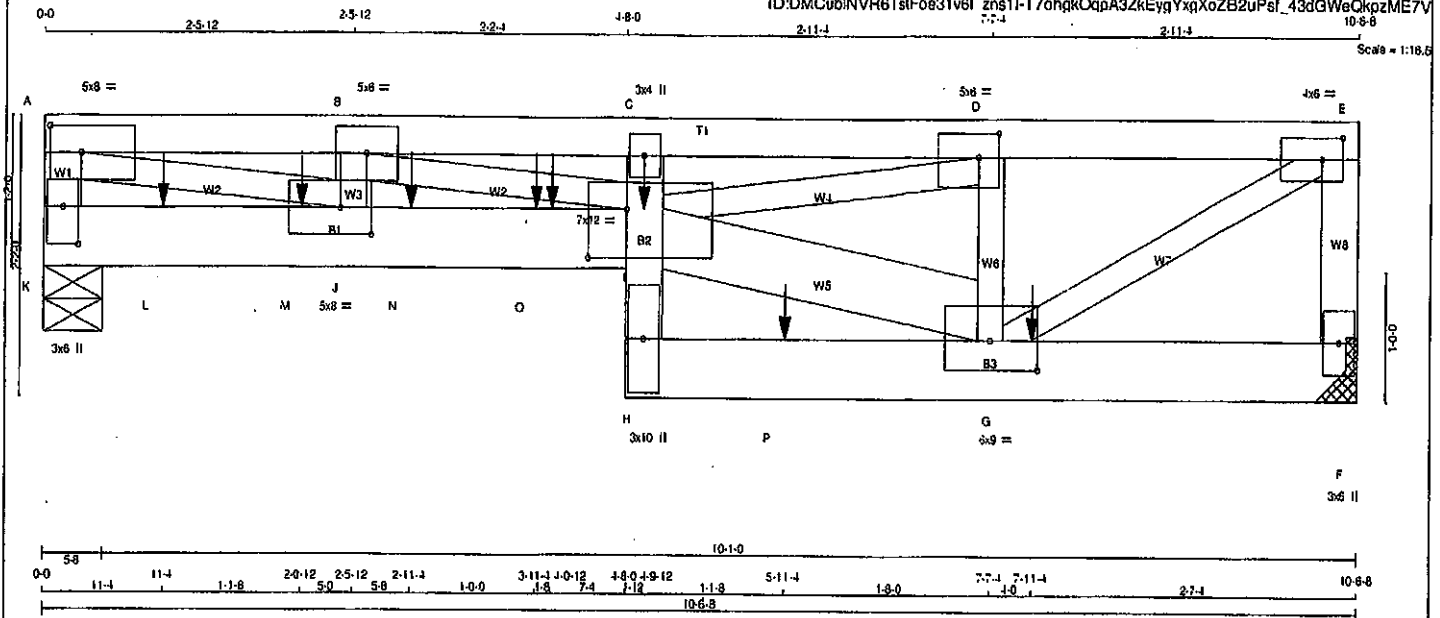

TOTAL WEIGHT = 2 X 49 = 98 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
K - A	2x4	DRY	No.2
A - E	2x4	DRY	No.2
F - E	2x4	DRY	No.2
K - I	2x6	DRY	No.2
H - C	2x4	DRY	No.2
H - F	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
I - G	2x6	DRY	No.2

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122'X3') SPIRAL NAILS		
K - A	12	TOP
A - E	12	TOP
E - F	12	TOP
BOTTOM CHORDS : (0.122'X3') SPIRAL NAILS		
K - I	12	SIDE (01.0)
H - F	12	SIDE (183.1)
C - H	5	SIDE (09.6)
WEBS : (0.122'X3') SPIRAL NAILS		
2x3	6	
2x6	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3.0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	DOWN	IN-SX	IN-SX
K 2804 0	2804 0	5-8	5-8
F 2255 0	2255 0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F MINIMUM BEARING LENGTH AT JOINT F = 4'-0".

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
K 1841 1212 0 0 0 0 0 0 0 0	
F 1592 1081 0 0 0 0 0 0 0 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.36 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD LGT (PLF)	MAX. UNBRACED LENGTH (LC)
FR-TO			
K-A	-2274 0	0.0 0.0 0.13 (1)	7.42
A-B	-6594 0	-91.8 -91.8 0.22 (1)	3.83
B-C	-10298 0	-91.8 -91.8 0.68 (1)	2.36
C-D	-9247 0	-91.8 -91.8 0.81 (1)	2.62
D-E	-3416 0	-91.8 -91.8 0.16 (1)	4.91
F-E	-2242 0	0.0 0.0 0.13 (1)	7.46
WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
I-G	0 2888	0.19 (1)	
I-O	0 5926	0.73 (1)	
G-D	-2148 0	0.17 (1)	
G-E	0 4043	0.50 (1)	
J-B	-1577 0	0.12 (1)	
A-J	0 7027	0.87 (1)	
B-I	0 3806	0.47 (1)	
K-L			
K-L	0 0	-18.5 -18.5 0.21 (1)	10.00
L-M	0 0	-18.5 -18.5 0.21 (1)	10.00
M-J	0 0	-18.5 -18.5 0.21 (1)	10.00
J-N	0 6694	-18.5 -18.5 0.79 (1)	10.00
N-O	0 6694	-18.5 -18.5 0.79 (1)	10.00
O-I	0 6694	-18.5 -18.5 0.79 (1)	10.00
H-I	0 364	0.0 0.0 0.65 (1)	10.00
I-C	0 128	0.0 0.0 0.63 (1)	10.00
H-P	0 832	-18.5 -18.5 0.20 (1)	10.00
P-G	0 832	-18.5 -18.5 0.20 (1)	10.00
G-F	0 0	-18.5 -18.5 0.01 (4)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
G	7-11-4	-661	-661	---	BACK	VERT	TOTAL	C1
I	4-9-12	-577	-577	---	FRONT	VERT	TOTAL	C1
L	11-4	-72	-72	---	BACK	VERT	TOTAL	C1
M	2-0-12	-352	-352	---	FRONT	VERT	TOTAL	C1
N	2-11-4	-142	-142	---	BACK	VERT	TOTAL	C1
O	3-11-4	-883	-883	---	BACK	VERT	TOTAL	C1
O	4-0-12	-354	-354	---	FRONT	VERT	TOTAL	C1
P	5-11-4	-556	-556	---	BACK	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9. NBCC 2010. NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35')
CALCULATED VERT. DEFL.(LL) = L/862 (0.15')
ALLOWABLE DEFL.(TL) = L/360 (0.35')
CALCULATED VERT. DEFL.(TL) = L/469 (0.27')

CS1: TC=0.66/1.00 (B-C:1), BC=0.79/1.00 (I-J:1),
WB=0.87/1.00 (A-J:1), SS1=0.45/1.00 (C-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 616 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (E) INPUT = 0.90
JSI METAL = 0.73 (D) INPUT = 1.00



Structural component only
DWG# T-2007675 1/2

CONTINUED ON PAGE 2


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T54S	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:20:14 2020 Page 2


ID:DMCubINVR6TstFoe31v6l zns1l-17ohgkQqpA3ZkEvgYxqXoZB2uPsf 43dGWaQkzME7V

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	5.0	8.0	2.50	3.00
B	TMVW-1	MT20	5.0	8.0		
C	TMV+p	MT20	3.0	4.0		
D	TMVW-1	MT20	5.0	6.0	2.25	2.00
E	TMVW-1	MT20	4.0	6.0	2.00	2.00
F	BMV1+p	MT20	3.0	6.0		
G	BMVWVW-1	MT20	6.0	9.0	2.75	4.50
H	BMV+p	MT20	3.0	10.0		
I	BMVWVW-1	MT20	7.0	12.0	4.50	3.75
J	BMVW-1	MT20	5.0	8.0	2.50	3.00
K	BMV1+p	MT20	3.0	6.0	3.50	1.50

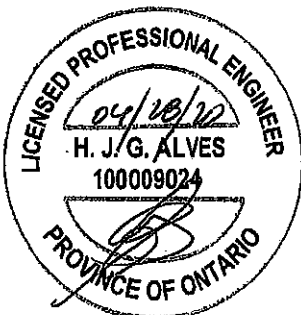

Structural component only
DWG# T-2007675 *HL*

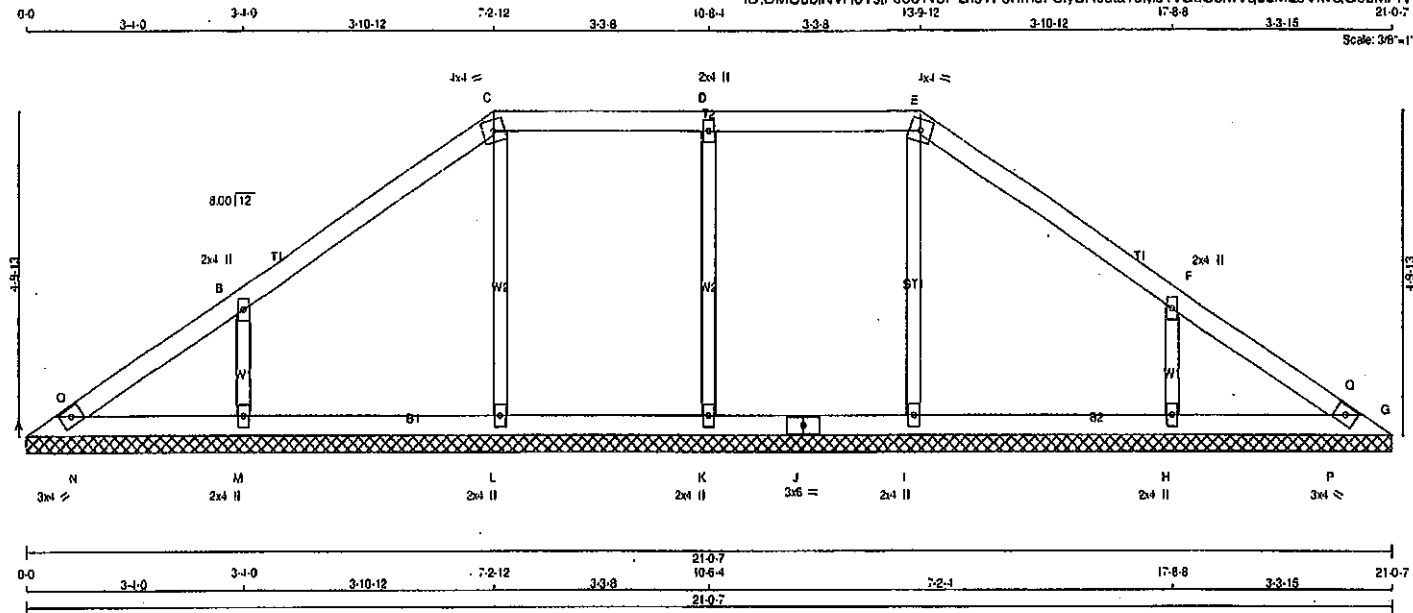

TOTAL WEIGHT = 83 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
A - J	2x4	DRY	No.2
J - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TBM1-h	MT20	3.0	4.0		
B, D, F						
B	TMW+sw	MT20	2.0	4.0		
C	TTW-m	MT20	4.0	4.0		
E	TTW-m	MT20	4.0	4.0		
G	TBM1-h	MT20	3.0	4.0		
H, I, K, L, M						
H	BMW1+sw	MT20	2.0	4.0		
J	BS-1	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	REQD
A	128	0	128	0	0	21-0-7 (11-112)20-7	BRG
G	128	0	128	0	0	21-0-7 (11-112)20-7	BRG
I	330	0	330	0	0	21-0-7 (11-112)20-7	BRG
L	330	0	330	0	0	21-0-7 (11-112)20-7	BRG
K	433	0	433	0	0	21-0-7 (11-112)20-7	BRG
H	485	0	485	0	0	21-0-7 (11-112)20-7	BRG
M	485	0	485	0	0	21-0-7 (11-112)20-7	BRG

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	COMBINED	90	0	0	0	0	29	0
G	COMBINED	90	0	0	0	0	29	0
I	COMBINED	235	143	0	0	0	93	0
L	COMBINED	235	143	0	0	0	93	0
K	COMBINED	304	212	0	0	0	92	0
H	COMBINED	342	228	0	0	0	114	0
M	COMBINED	342	228	0	0	0	114	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, G, I, L, K, H, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC1)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC1)
FR-TO		FROM TO			FR-TO		
A-O	-23 2	-91.8 -91.8	0.04 (1)	6.25	I-E	-285 0	0.09 (1)
O-B	0 33	-91.8 -91.8	0.21 (1)	10.00	L-C	-288 0	0.09 (1)
B-C	-8 8	-91.8 -91.8	0.20 (1)	10.00	K-D	-377 0	0.13 (1)
C-D	0 17	-91.8 -91.8	0.17 (1)	10.00	H-F	-393 0	0.06 (1)
D-E	0 17	-91.8 -91.8	0.17 (1)	10.00	M-B	-393 0	0.06 (1)
E-F	-8 8	-91.8 -91.8	0.20 (1)	10.00	N-O	-39 5	0.00 (1)
F-G	0 33	-91.8 -91.8	0.21 (1)	10.00	P-Q	-39 5	0.00 (1)
Q-G	-23 2	-91.8 -91.8	0.04 (1)	6.25			
A-N	-9 0	-18.5 -18.5	0.05 (1)	10.00			
N-M	-7 7	-18.5 -18.5	0.06 (4)	10.00			
M-L	-11 0	-18.5 -18.5	0.06 (4)	6.25			
L-K	-17 0	-18.5 -18.5	0.05 (4)	6.25			
K-J	-17 0	-18.5 -18.5	0.05 (4)	6.25			
J-I	-17 0	-18.5 -18.5	0.05 (4)	6.25			
I-H	-11 0	-18.5 -18.5	0.06 (4)	6.25			
H-P	-7 7	-18.5 -18.5	0.06 (4)	10.00			
P-G	-9 0	-18.5 -18.5	0.05 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.21 (B-O:1) , BC=0.06 (L-M:4) , WB=0.13 (D-K:1) , SBI=0.15 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 616 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.61 (C) (INPUT = 0.90)
JSI METAL= 0.20 (F) (INPUT = 1.00)

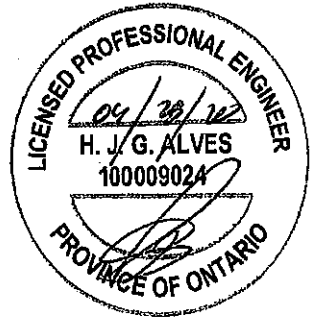


Structural component only
DWG# T-2007616

JOB NAME	TRUSS NAME	QUANTITY	PLV	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	V2	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:15 2020 Page 1

ID:DMCubINVR6TsiFoe31v6i zns11-UIKTTnJa hRUUKaLwZ38oYw1qu824qpFkOeozTzMFILU
10-3-12 18-0-7

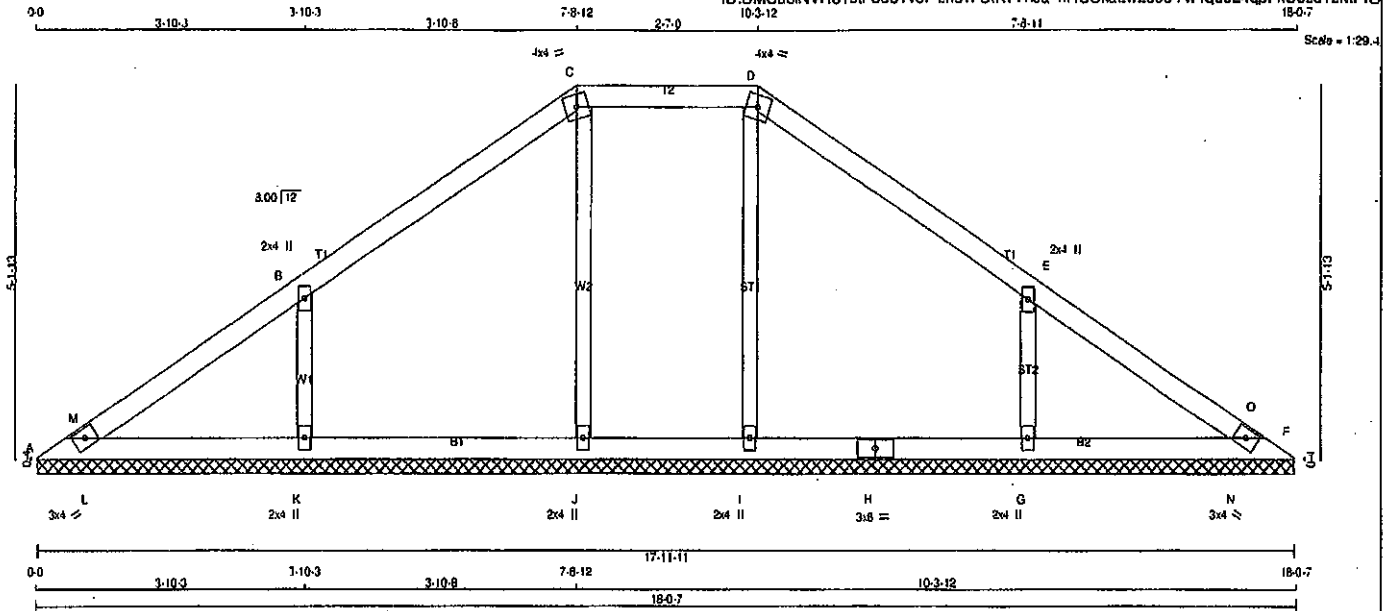

TOTAL WEIGHT = 54 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
A - H	2x4	DRY	No.2
H - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TBM1-h	MT20	3.0	4.0
B	TBM1-w	MT20	2.0	4.0
C	TTW-m	MT20	4.0	4.0
D	TTW-m	MT20	4.0	4.0
E	TTW-w	MT20	2.0	4.0
F	TBM1-h	MT20	3.0	4.0
G, I, J, K				
G	BMW1-w	MT20	2.0	4.0
H	BS-l	MT20	3.0	6.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED DOWN		INPUT BRG UPLIFT	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
A	138	0	138	0	0	17-11-11 (11-17-12-11)
F	135	0	135	0	0	17-11-11 (11-17-12-11)
I	344	0	344	0	0	17-11-11 (11-17-12-11)
G	513	0	513	0	0	17-11-11 (11-17-12-11)
J	342	0	342	0	0	17-11-11 (11-17-12-11)
K	513	0	513	0	0	17-11-11 (11-17-12-11)

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	COMBINED	1ST CASE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
		SNOW	LIVE	PERM. LIVE				
A	98	85	0	0	0	0	30	0
F	95	85	0	0	0	0	30	0
I	244	155	0	0	0	0	80	0
G	362	240	0	0	0	0	122	0
J	242	154	0	0	0	0	88	0
K	362	240	0	0	0	0	122	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, F, I, G, J, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-M	0 20	-91.8 -91.8	0.04 (1)	I-D	-292 0	0.11 (1)	
M-B	0 71	-91.8 -91.8	0.22 (1)	G-E	-408 0	0.07 (1)	
B-C	0 33	-91.8 -91.8	0.22 (1)	J-C	-291 0	0.11 (1)	
C-D	0 52	-91.8 -91.8	0.11 (1)	K-B	-408 0	0.07 (1)	
D-E	0 33	-91.8 -91.8	0.22 (1)	L-M	-71 4	0.00 (1)	
E-O	0 71	-91.8 -91.8	0.22 (1)	N-O	-89 5	0.00 (1)	
O-F	0 19	-91.8 -91.8	0.04 (1)				
A-L	-43 0	-18.5 -18.5	0.07 (1)				8.25
L-K	-30 0	-18.5 -18.5	0.07 (1)				8.25
K-J	-45 0	-18.5 -18.5	0.07 (4)				8.25
J-I	-52 0	-18.5 -18.5	0.04 (4)				6.25
I-H	-45 0	-18.5 -18.5	0.07 (4)				8.25
H-G	-45 0	-18.5 -18.5	0.07 (4)				6.25
G-N	-30 0	-18.5 -18.5	0.07 (1)				6.25
N-F	-43 0	-18.5 -18.5	0.07 (1)				6.25

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN (LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.22/1.00 (E-O:1), BC=0.07/1.00 (K-L:1), WB=0.11/1.00 (D-I:1), SS=0.14/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP (DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1667
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.81 (C) (INPUT = 0.90)

JSI METAL = 0.21 (E) (INPUT = 1.00)

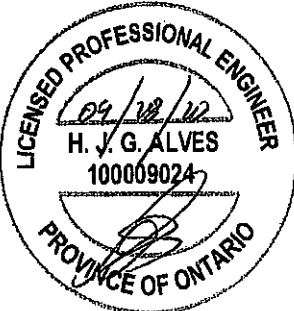


Structural component only
DWG# T-2007617

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	V3	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:00:16 2020 Page 1

ID:DMCubINVR6TstFos31vdl_zns11-y41rg7JCl_ZL6u9XTGaNLmTClVXpH4Oy2OWKvzMfIT

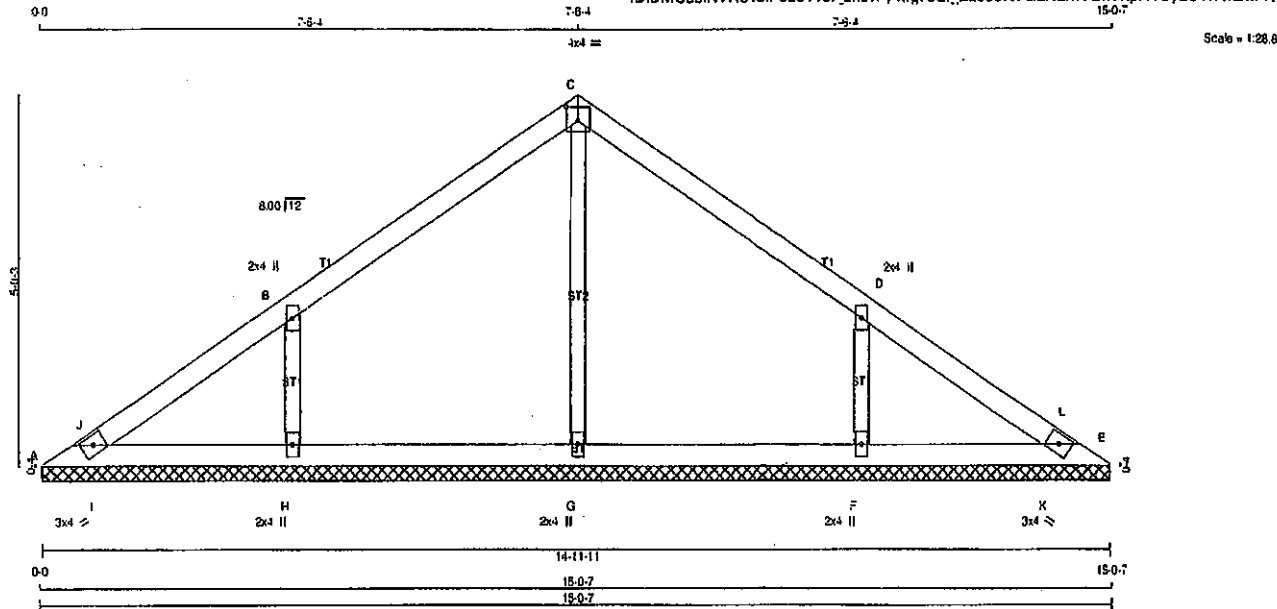

TOTAL WEIGHT = 43 lb (M)

CHORDS	SIZE	DRY	NO. 2
A - C	2x4	DRY	No. 2
C - E	2x4	DRY	No. 2
A - E	2x4	DRY	No. 2

ALL WEBS 2x3 DRY
DRY: SEASONED LUMBER.

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE PLATES				
A TBM1-h	MT20	3.0	4.0	
B TBM1-h	MT20	2.0	4.0	
C TTW-p	MT20	4.0	4.0	2.25 2.00
D TBM1-h	MT20	2.0	4.0	
E TBM1-h	MT20	3.0	4.0	
F, G, H				
F BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	RECORD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
A	134	0	134	0	14-11-11	14-11-11
E	134	0	134	0	14-11-11	14-11-11
G	381	0	381	0	14-11-11	14-11-11
H	501	0	501	0	14-11-11	14-11-11
F	501	0	501	0	14-11-11	14-11-11

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	95	65 0	0 0	0 0	0 0	30 0	0 0
E	95	65 0	0 0	0 0	0 0	30 0	0 0
G	272	182 0	0 0	0 0	0 0	110 0	0 0
H	353	237 0	0 0	0 0	0 0	116 0	0 0
F	353	237 0	0 0	0 0	0 0	116 0	0 0

BEARING MATERIAL TO BE SPF NO. 2 OR BETTER AT JOINT(S) A, E, G, H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)		MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
		FROM TO	TO FROM				
FR-TO							
A-J	-20 4	-91.8	-91.8	0.04 (1)	6.25	G-C	-316 0
J-B	0 38	-91.8	-91.8	0.22 (1)	10.00	H-B	-406 0
B-C	-5 12	-91.8	-91.8	0.21 (1)	10.00	F-D	-406 0
C-D	-5 12	-91.8	-91.8	0.21 (1)	10.00	I-J	-46 6
D-L	0 36	-91.8	-91.8	0.22 (1)	10.00	K-L	-46 6
L-E	-20 4	-91.8	-91.8	0.04 (1)	6.25		
A-I	-13 0	-18.5	-18.5	0.06 (1)	6.25		
I-H	-10 3	-18.5	-18.5	0.06 (4)	6.25		
H-G	-13 0	-18.5	-18.5	0.06 (4)	6.25		
G-F	-13 0	-18.5	-18.5	0.06 (4)	6.25		
F-K	-10 3	-18.5	-18.5	0.06 (4)	6.25		
K-E	-13 0	-18.5	-18.5	0.06 (1)	6.25		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.22(1.00 (B-J:1) , BC=0.08(1.00 (G-H:4) , WB=0.11(1.00 (C-G:1) , SSI=0.15(1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.28 (D) (INPUT = 0.90)
JSI METAL = 0.21 (D) (INPUT = 1.00)

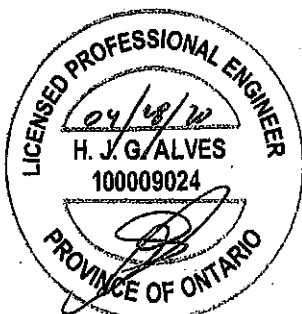


Structural component only
DWG# T-2007618

JOB NAME 408222	TRUSS NAME V4	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	ORWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 28 2019 MTek Industries, Inc. Tue Apr 28 11:37:42 2020 Page 1

ID:DMCubINVR6TstFoe31v8l_zns1i-NKegA2eMCGI4MYH_q82VAKhU92Pb0QNm3fZNSpZMD_

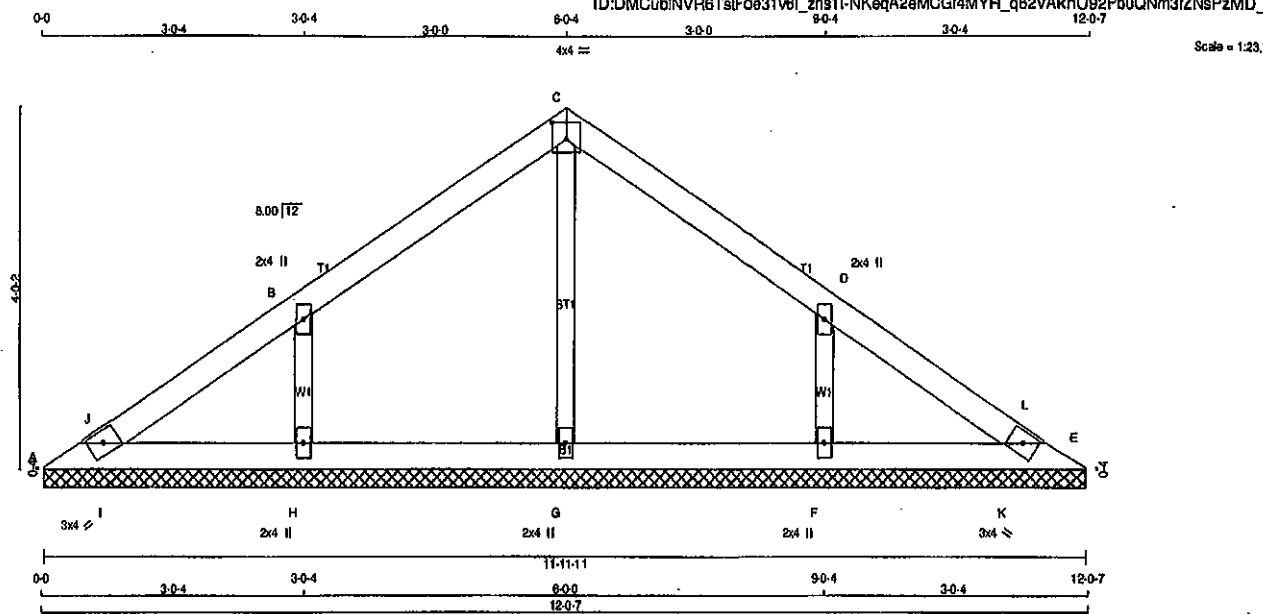

TOTAL WEIGHT = 34 lb

LUMBER			
N.L.G.A. RULES	CHORDS	SIZE	DRY
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
A - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TBM1-h	MT20	3.0	4.0
B	TMW-w	MT20	2.0	4.0
C	TTW-p	MT20	4.0	4.0 2.25 2.00
D	TMW-w	MT20	2.0	4.0
E	TBM1-h	MT20	3.0	4.0
F, G, H	BMW1-w	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
A	117	0	117	0	0	11-11-11	11-11-11	11-11-11	11-11-11
E	117	0	117	0	0	11-11-11	11-11-11	11-11-11	11-11-11
G	290	0	290	0	0	11-11-11	11-11-11	11-11-11	11-11-11
F	398	0	398	0	0	11-11-11	11-11-11	11-11-11	11-11-11
H	398	0	398	0	0	11-11-11	11-11-11	11-11-11	11-11-11

UNFACTORED REACTIONS

1ST CASE		MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	83	587.0	0.0	0.0	0.0	287.0	0.0
E	83	587.0	0.0	0.0	0.0	287.0	0.0
G	207	1257.0	0.0	0.0	0.0	827.0	0.0
F	281	1887.0	0.0	0.0	0.0	937.0	0.0
H	281	1887.0	0.0	0.0	0.0	937.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, G, F, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-J	-87.5	-91.8 -91.8 0.03 (1)	10.00	G-C	-2487.0	0.08 (1)	
J-B	0738	-91.8 -91.8 0.13 (1)	10.00	F-D	-3147.0	0.05 (1)	
B-C	0712	-91.8 -91.8 0.13 (1)	10.00	H-B	-3147.0	0.05 (1)	
C-D	0712	-91.8 -91.8 0.13 (1)	10.00	I-J	-477.4	0.00 (1)	
D-L	0736	-91.8 -91.8 0.13 (1)	10.00	K-L	-477.4	0.00 (1)	
L-E	-87.5	-91.8 -91.8 0.03 (1)	10.00				
A-I	-137.0	-18.5 -18.5 0.05 (1)	6.25				
I-H	-107.0	-18.5 -18.5 0.05 (1)	10.00				
H-G	-207.0	-18.5 -18.5 0.04 (4)	6.25				
G-F	-207.0	-18.5 -18.5 0.04 (4)	6.25				
F-K	-107.0	-18.5 -18.5 0.05 (1)	10.00				
K-E	-137.0	-18.5 -18.5 0.05 (1)	6.25				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(88% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TO=0.13/1.00 (B-J:1), BC=0.05/1.00 (A-I:1), WB=0.08/1.00 (C-G:1), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.22 (D) (INPUT = 0.90)
JSI METAL = 0.16 (B) (INPUT = 1.00)

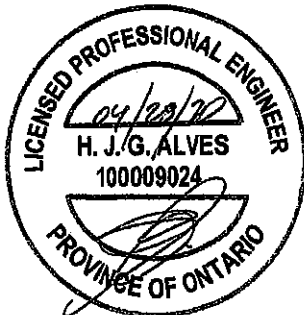


Structural component only
DWG# T-2007619

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	V5	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 © Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:17 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-QGREITKqWthCk2kk1_6ctz?N9ip5YjBYBi74ILZMFIS

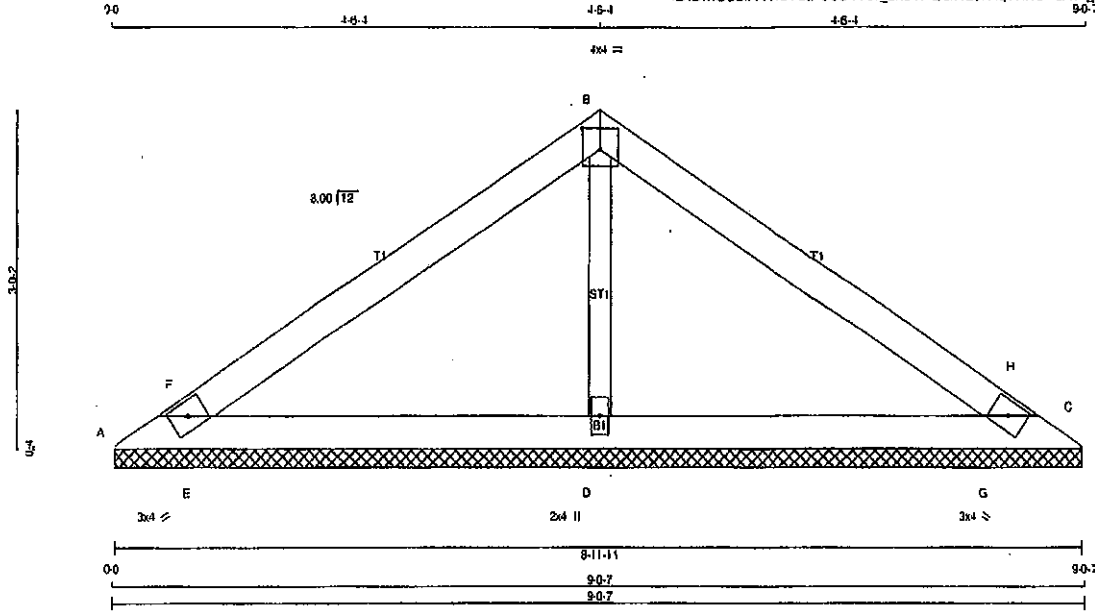

TOTAL WEIGHT = 23 lb (M)

LUMBER	DESCR
N. L. G. A. RULES	
CHORDS SIZE	
A - B 2x4 DRY	No.2
B - C 2x4 DRY	No.2
A - C 2x4 DRY	No.2
ALL WEBS 2x3 DRY	No.2
DRY: SEASONED LUMBER.	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED		MAXIMUM FACTORED		INPUT		REQD	
	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	BRG	IN-SX	IN-SX
A	49	0	49	0	8-11-11	8-11-11		
C	49	0	49	0	8-11-11	8-11-11		
D	893	0	893	0	8-11-11	8-11-11		

UNFACTORED REACTIONS

JT	1ST LCASE		MAX/MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	34	22.0	0.0	0.0	0.0	12.0	0.0
C	34	22.0	0.0	0.0	0.0	12.0	0.0
D	831	415.0	0.0	0.0	0.0	216.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-F	0 347	-91.8 -91.8	0.12 (1)	10.00	D-B	-698 0 0.12 (1)	
F-B	0 341	-91.8 -91.8	0.23 (1)	10.00	E-F	-225 0 0.00 (1)	
B-H	0 341	-91.8 -91.8	0.23 (1)	10.00	G-H	-225 0 0.00 (1)	
H-C	0 347	-91.8 -91.8	0.12 (1)	10.00			
A-E	-321 0	-18.5 -18.5	0.16 (1)	8.25			
E-D	-290 0	-18.5 -18.5	0.17 (1)	8.25			
D-G	-290 0	-18.5 -18.5	0.17 (1)	8.25			
G-C	-321 0	-18.5 -18.5	0.16 (1)	8.25			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.23/1.00 (B-F:1), BC=0.17/1.00 (D-E:1), WB=0.12/1.00 (B-D:1), SS=0.12/1.00 (A-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1667 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.59 (B) INPUT = 0.90
JSI METAL = 0.20 (B) INPUT = 1.00

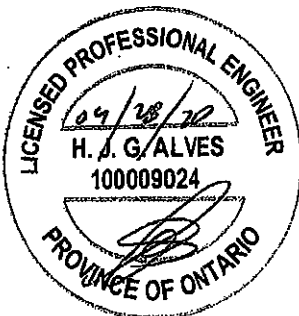


Structural component only
DWG# T-2007620

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	PB1	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 08:00:02 2020 Page 1

ID:DMCubINVR6TstFoe31v6I zns11-MN1Zkl9Q2hoKQ4rKfK5mpuqJfjFXyLks7nrjzMFih

Scale = 1:16.4

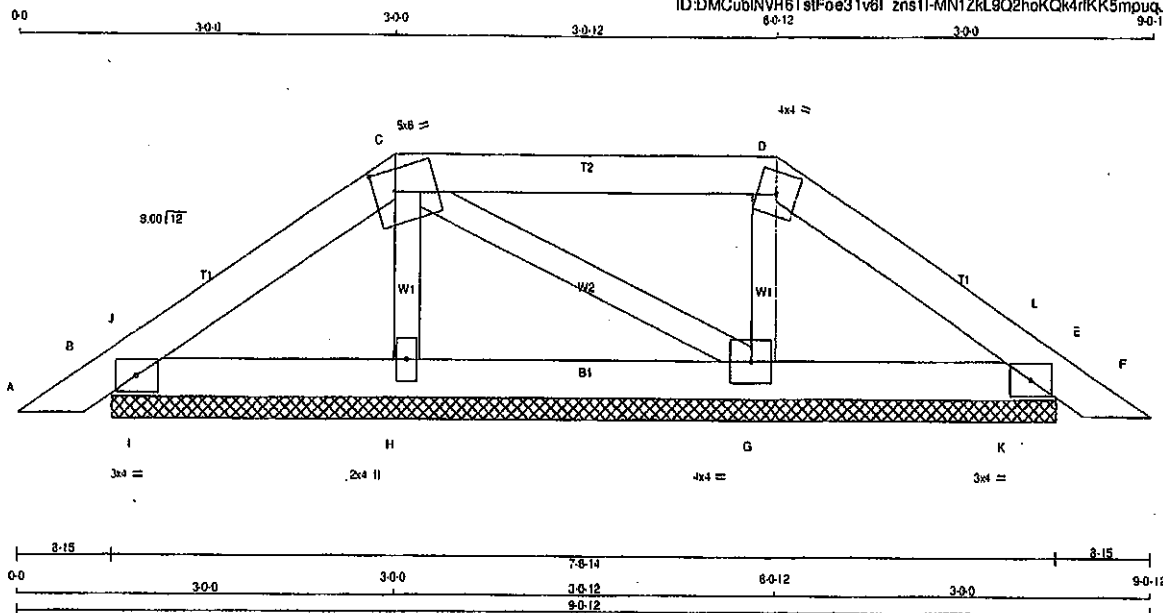

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
B - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
SPF			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TM81-I	MT20	3.0	4.0	
C	TTWW-m	MT20	5.0	8.0	2.00 2.00
D	TTWW-m	MT20	4.0	4.0	
E	TM81-I	MT20	3.0	4.0	
G	BMWW-I	MT20	4.0	4.0	
H	BMWW-I	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	IN-SX	BRG
B	221	0	0	221	0	0	0	7-8-14	7-6-14
E	209	0	0	209	0	0	0	7-8-14	7-6-14
H	248	0	0	248	0	0	0	7-8-14	7-6-14
G	260	0	0	280	0	0	0	7-8-14	7-6-14

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	COMBINED	SNOW	LIVE	PERM. LIVE
B	154	113	0	0	0	0	0	41	0	0	0
E	146	108	0	0	0	0	0	39	0	0	0
H	178	109	0	0	0	0	0	67	0	0	0
G	198	127	0	0	0	0	0	71	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FORCE (LBS)	MAX. CSI (LC)	UNBRACED LENGTH (FT)
FR-TO				FR-TO			
A-B	0 15	-91.8	-91.8 0.03 (1)	H-C	-178 0	0.03 (1)	10.00
B-J	-63 0	-91.8	-91.8 0.01 (1)	C-G	-21 0	0.00 (1)	6.25
J-C	-75 0	-91.8	-91.8 0.05 (1)	G-D	-198 0	0.03 (1)	6.25
C-D	-30 0	-91.8	-91.8 0.15 (1)	I-J	-121 0	0.00 (1)	6.25
D-L	-54 0	-91.8	-91.8 0.05 (1)	K-L	-123 0	0.00 (1)	6.25
L-E	-41 0	-91.8	-91.8 0.01 (1)				
E-F	0 15	-91.8	-91.8 0.03 (1)				10.00
B-I	0 80	-18.5	-18.5 0.05 (1)				10.00
I-H	0 60	-18.5	-18.5 0.08 (1)				10.00
H-G	0 48	-18.5	-18.5 0.03 (1)				10.00
G-K	0 43	-18.5	-18.5 0.08 (1)				10.00
K-E	0 43	-18.5	-18.5 0.05 (1)				10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.15/1.00 (C-D:1), BC=0.08/1.00 (B-I:1), WB=0.03/1.00 (D-G:1), SS=0.11/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	616	354
	1667	1987

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.18 (B) (INPUT = 0.90)
JSI METAL = 0.04 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007600

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	PB2	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:03 2020 Page 1
ID:DMCubINVR6TslFoe31v6l_zns11-qabxxh92p7wB2uf2D2sKJQC7w31_GPEUzWkKN9zMF1q

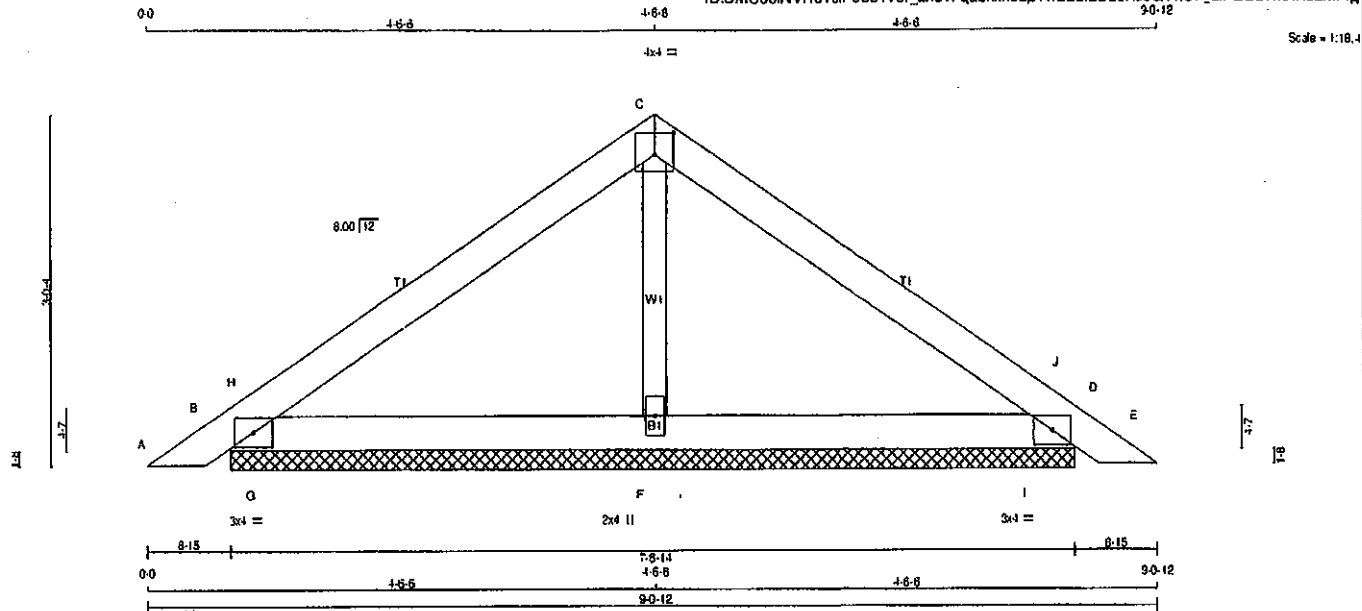

TOTAL WEIGHT = 2 X 23 = 46 lb

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR.
A - C	2x4	DRY	No.2		SPF
C - E	2x4	DRY	No.2		SPF
B - D	2x4	DRY	No.2		SPF
ALL WEBS		2x3	DRY	No.2	SPF
DRY; SEASONED LUMBER.					

PLATES (table in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0			
C	TTW-p	MT20	4.0	4.0	2.25	2.00	
D	TMB1-I	MT20	3.0	4.0			
F	BMW1+w	MT20	2.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
B	318	0	318	0
D	318	0	318	0
F	320	0	320	0

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED						
B	223	159	0	0	0	63	0
D	223	159	0	0	0	63	0
F	229	137	0	0	0	92	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: 141

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX	MEMB.	FORCE	MAX
MEMB.	FORCE	VERT. LOAD	LC1	MAX	MAX	MEMB.	FORCE	MAX	
(LBS)	(LBS)	(PLF)	(LC)	(LC)	(LC)	(LBS)	(LBS)	(LC)	
FR-TO	FROM	TO	LENGTH	FR-TO	FROM	TO	LENGTH	FR-TO	FROM
A-B	0	15	-91.8	-91.8	0.03 (1)	10.00	F-C	-148	0
B-H	-31	0	-91.8	-91.8	0.07 (1)	6.25	G-H	-349	0
H-C	-135	0	-91.8	-91.8	0.16 (1)	8.25	I-J	-349	0
C-J	-135	0	-91.8	-91.8	0.16 (1)	8.25			
J-D	-31	0	-91.8	-91.8	0.07 (1)	6.25			
D-E	0	15	-91.8	-91.8	0.03 (1)	10.00			
B-G	0	105	-18.5	-18.5	0.15 (1)	10.00			
G-F	0	105	-18.5	-18.5	0.15 (1)	10.00			
F-I	0	105	-18.5	-18.5	0.15 (1)	10.00			
I-D	0	105	-18.5	-18.5	0.15 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCG 2010, NBCG 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.18/1.00 (C-J); BC=0.15/1.00 (F-I); WB=0.03/1.00 (C-F); SS=0.26/1.00 (D-E)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MT20	618	354	1667
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.28 (D) INPUT = 0.30
JSI METAL= 0.07 (D) INPUT = 1.00




Structural component only
DWG# T-2007801

JOB NAME 408223	TRUSS NAME PB20	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 3.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:03:58 2020 Page 1
ID:DMCubINVR6TsIF0831v81 zns11-5 izPKYM7hrKOxBJFY7B9Jg2AAFeY9gNMkIPVzMEMn

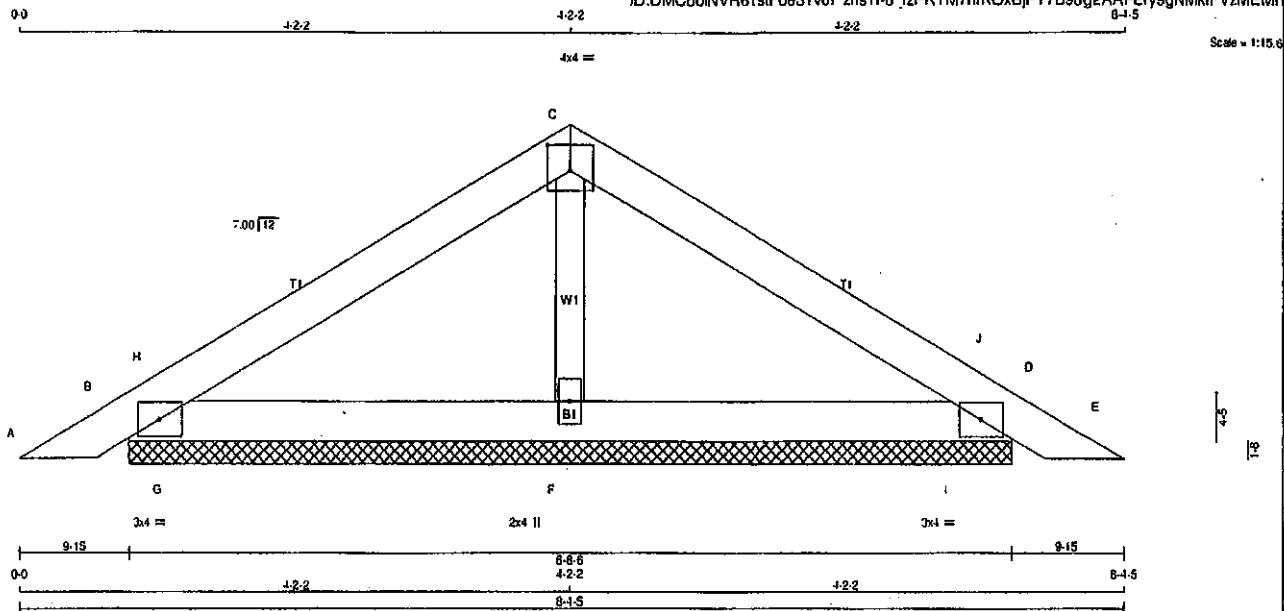

TOTAL WEIGHT = 4 X 20 = 80 lb

LUMBER

N. L. G. A. RULES					
CHORDS	SIZE	LUMBER	DESCR.	SPF	
A - C	2x4 DRY	No.2	SPF		
C - E	2x4 DRY	No.2	SPF		
B - D	2x4 DRY	No.2	SPF		
ALL WEBS	2x3 DRY	No.2	SPF		
DRY: SEASONED LUMBER.					

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0		
C	TTW-P	MT20	4.0	4.0	2.25	2.00
D	TMB1-I	MT20	3.0	4.0		
F	BMW1+W	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		GROSS REACTION		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX	BRG
B	281	0	281	0	0	6-8-6	6-8-6	6-8-6	6-8-6
D	281	0	281	0	0	6-8-6	6-8-6	6-8-6	6-8-6
F	314	0	314	0	0	6-8-6	6-8-6	6-8-6	6-8-6

UNFACTORED REACTIONS

JT	1ST LOASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
B	197	141 0	0 0	0 0	55 0	0 0
D	187	141 0	0 0	0 0	55 0	0 0
F	224	137 0	0 0	0 0	87 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 18	-91.8 -91.8	0.04 (1)	10.00	F-C	-159 0	0.02 (1)
B-H	-44 0	-91.8 -91.8	0.05 (1)	6.25	G-H	-250 0	0.00 (1)
H-C	-99 0	-91.8 -91.8	0.12 (1)	6.25	I-J	-250 0	0.00 (1)
C-J	-99 0	-91.8 -91.8	0.12 (1)	8.25			
J-D	-44 0	-91.8 -91.8	0.05 (1)	8.25			
D-E	0 16	-91.8 -91.8	0.04 (1)	10.00			
B-G	0 81	-18.5 -18.5	0.12 (1)	10.00			
G-F	0 81	-18.5 -18.5	0.12 (1)	10.00			
F-I	0 81	-18.5 -18.5	0.12 (1)	10.00			
I-D	0 81	-18.5 -18.5	0.12 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (C-H:1), 8C=0.12/1.00 (B-G:1), WB=0.02/1.00 (C-F:1), SS=0.18/1.00 (D-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION	(PSI)	(PLI)	(PLI)
MAX MIN MAX MIN MAX MIN			
MT20 618 354 1667 788 1987 1856			

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (D) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007627

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	PB21	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:03:57 2020 Page 1

ID:DMCubINVR6TstFoa31v6I zns11-aAGLcIZ u zB05lvPFeQXDDeZbFaPRpb0UDxxzMEMm

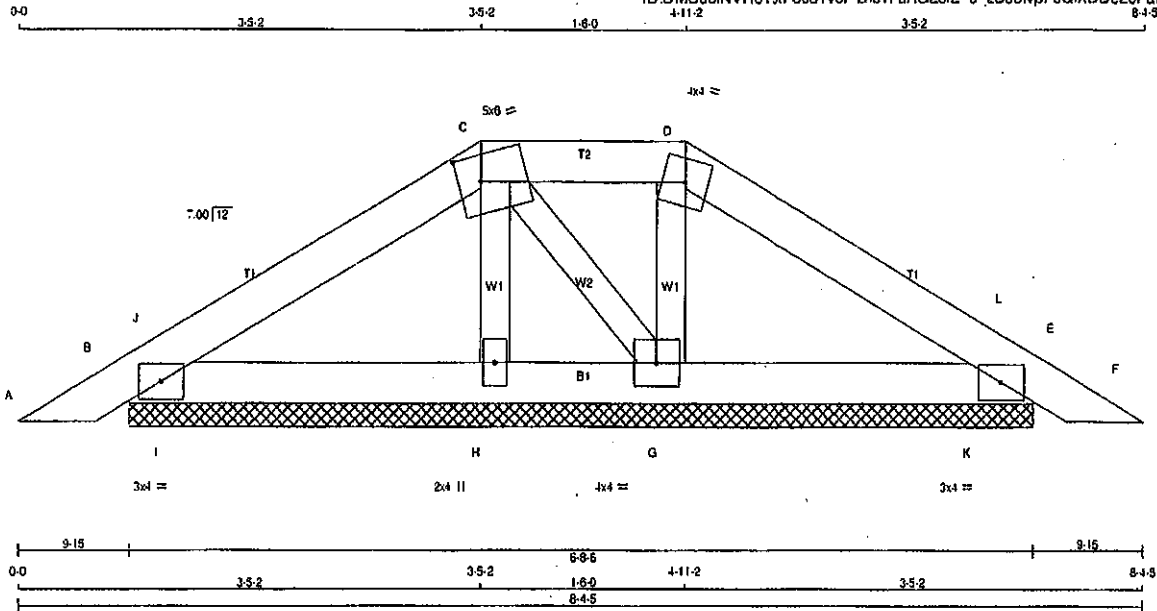

Scale = 1:15.2

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
B - E	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TM81-J	MT20	3.0	4.0
C	TTW-m	MT20	5.0	6.0 2.25 2.00
D	TTW-m	MT20	4.0	4.0
E	TM81-J	MT20	3.0	4.0
G	BMW1-i	MT20	4.0	4.0
H	BMW1-w	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
B	241	0	241	0	6-8-6
E	228	0	228	0	6-8-6
H	170	0	170	0	6-8-6
G	238	0	238	0	6-8-6

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN.	COMPONENT REACTIONS	PERM	LIVE	WIND	DEAD	SOIL
B	169	121	0	0	0	0	48	0
E	160	114	0	0	0	0	48	0
H	122	74	0	0	0	0	48	0
G	168	111	0	0	0	0	57	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
A-B	0 18	H-C	-107 0
B-J	-59 0	C-G	-38 0
J-C	-71 0	G-D	-147 0
C-D	-28 0	D-I	-139 0
D-L	-46 0	I-J	-141 0
L-E	-33 0	J-K	-141 0
E-F	0 18	K-L	-141 0

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS DESIGN IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012: ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.07 (D-L:1), SC=0.07 (B-I:1), WB=0.02 (D-G:1), SSI=0.11 (E-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.19 (B) (INPUT = 0.90)
JSI METAL = 0.05 (D) (INPUT = 1.00)



Structural component only
DWG# T-2007628

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	PB22	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:03:58 2020 Page 1
ID:DMCubINVR6TstFoe31v61_zns11-2Mqjg7ac152efK5Nz9fEkmO2zyGJsPzqgDmTNzMEMI

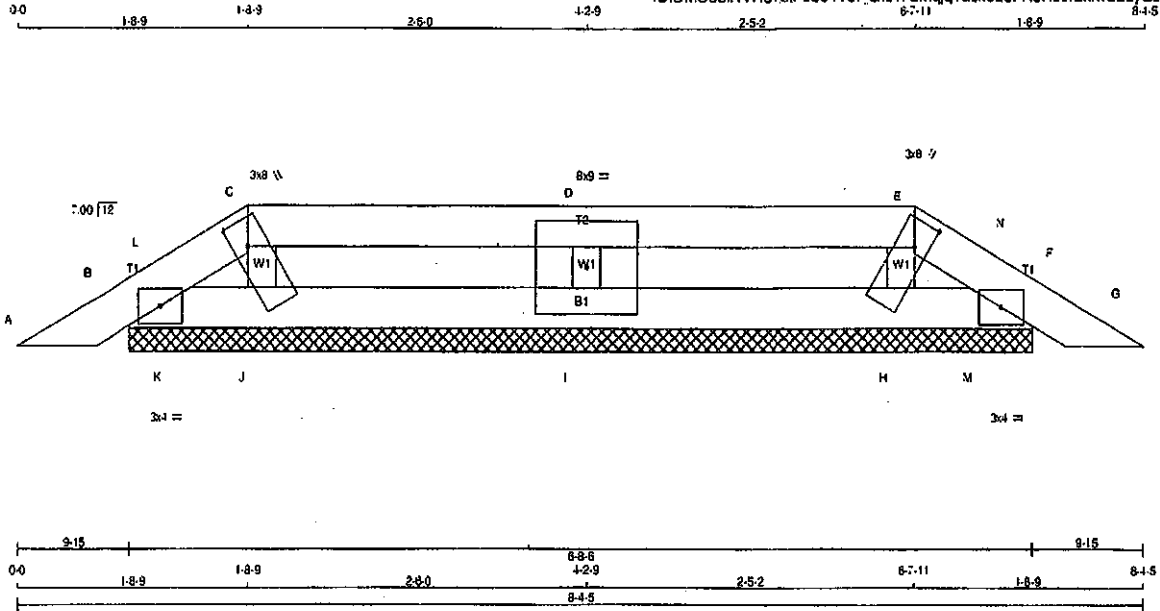

Scale = 1:15.2

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER
A - C 2x4 DRY No.2
C - E 2x4 DRY No.2
E - G 2x4 DRY No.2
G - I 2x4 DRY No.2
ALL WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

PLATES (table in inches)
JT TYPE PLATES W LEN Y X
B TMB1-I MT20 3.0 4.0
C, D, E, H, I, J
C TTBW1+h MT20 3.0 8.0 2.25 1.25
D TTBW1+h MT20 3.0 8.0 2.25 1.25
E TTBW1+h MT20 3.0 8.0 2.25 1.25
F TMB1-I MT20 3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	VERT	HORIZ	DOWN	HORIZ	UPLIFT	IN-SX	IN-SX
B	151	0	151	0	0	6-8-6	6-8-6
F	152	0	152	0	0	6-8-6	6-8-6
J	125	0	125	0	0	6-8-6	6-8-6
H	120	0	120	0	0	6-8-6	6-8-6
I	330	0	330	0	0	6-8-6	6-8-6

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	105	83	0	0	0	21	0
F	105	83	0	0	0	22	0
J	90	49	0	0	0	41	0
H	86	47	0	0	0	39	0
I	232	158	0	0	0	74	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS B, F, J, H, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO						FR-TO				
A-B	0 16	-91.8	-91.8	0.04 (1)	10.00	J-C	-95	0	0.01 (1)	
B-L	-53 0	-91.8	-91.8	0.04 (1)	6.25	H-E	-92	0	0.01 (1)	
L-C	-22 0	-91.8	-91.8	0.01 (1)	6.25	I-D	-282	0	0.04 (1)	
C-D	0 3	-91.8	-91.8	0.09 (1)	10.00	K-L	-1 12	0.00 (1)		
D-E	0 3	-91.8	-91.8	0.09 (1)	10.00	M-N	0 13	0.00 (1)		
E-N	-21 0	-91.8	-91.8	0.01 (1)	6.25					
N-F	-52 0	-91.8	-91.8	0.04 (1)	6.25					
F-G	0 16	-91.8	-91.8	0.04 (1)	10.00					
B-K	0 14	-18.5	-18.5	0.01 (1)	10.00					
K-J	0 14	-18.5	-18.5	0.02 (4)	10.00					
J-I	-3 0	-18.5	-18.5	0.02 (4)	10.00					
I-H	-3 0	-18.5	-18.5	0.02 (4)	10.00					
H-M	0 14	-18.5	-18.5	0.01 (4)	10.00					
M-F	0 14	-18.5	-18.5	0.01 (1)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS: TC=0.09/1.00 (D-E:1), BC=0.02/1.00 (H-J:4), WB=0.04/1.00 (D-I:1), SS=0.11/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.13 (C) (INPUT = 0.90)
JSI METAL = 0.04 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007629

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	P20	17	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

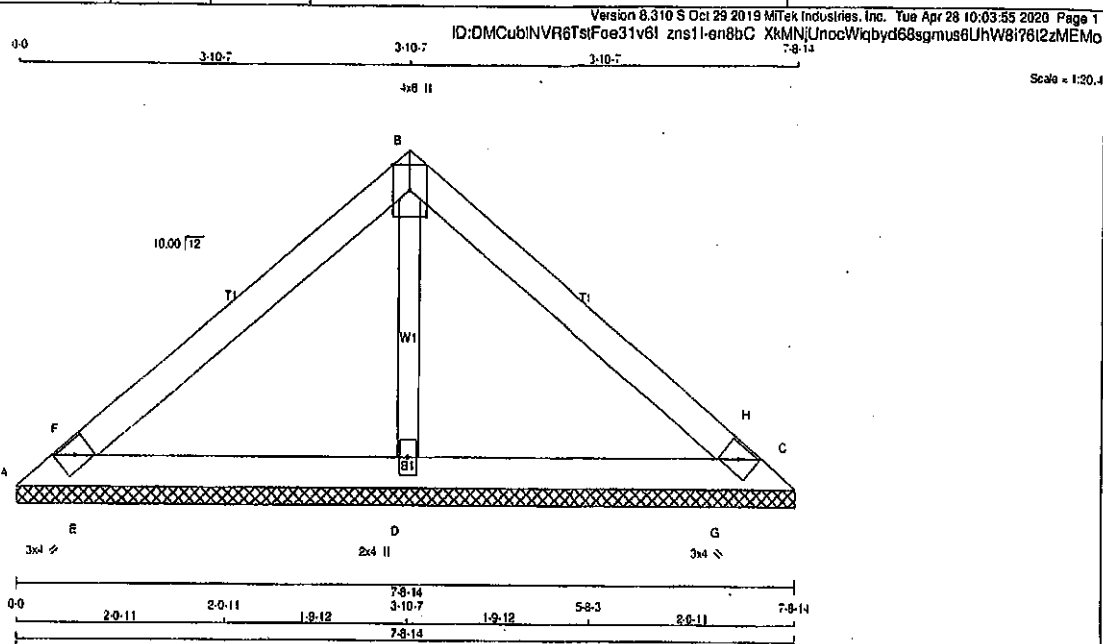

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4 DRY	No.2	SPF
B - C	2x4 DRY	No.2	SPF
A - C	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
DRY: SEASONED LUMBER.			

PLATES (Table 19 in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TBM1-h	MT20	3.0	4.0	
B	TTW+p	MT20	4.0	6.0	Edge
C	TBM1-h	MT20	3.0	4.0	
D	BMW1+w	MT20	2.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REORD	
JT	VERT	GROSS REACTION	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX
A	60	0	0	60	0	0	7-8-14	7-8-14	
C	60	0	0	60	0	0	7-8-14	7-8-14	
D	733	0	0	733	0	0	7-8-14	7-8-14	

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	43	28.0	0.0	0.0	0.0	0.0	14.0	0.0
C	42	28.0	0.0	0.0	0.0	0.0	14.0	0.0
D	518	339.0	0.0	0.0	0.0	0.0	179.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS) A, C, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLP)	MAX. GSI (LC)	MEMB.	MAX. FORCE (LBS)	MAX. GSI (LC)	
FR-TO		FROM	TO	FR-TO			
A-F	0 227	-91.8	-91.8 0.09 (1)	10.00	D-B	-558 0	0.10 (1)
F-B	0 219	-91.8	-91.8 0.17 (1)	10.00	E-F	-199 0	0.00 (1)
B-H	0 219	-91.8	-91.8 0.17 (1)	10.00	G-H	-199 0	0.00 (1)
H-C	0 228	-91.8	-91.8 0.09 (1)	10.00			
A-E	-207 0	-18.5	-18.5 0.13 (1)	8.25			
E-D	-174 0	-18.5	-18.5 0.13 (1)	8.25			
D-G	-174 0	-18.5	-18.5 0.13 (1)	8.25			
G-C	-207 0	-18.5	-18.5 0.13 (1)	8.25			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.17 1.00 (B-F:1), BC=0.13/1.00 (D-E:1), WB=0.10/1.00 (B-D:1), SS=0.11/1.00 (C-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.29 (0) INPUT = 0.90
JSI METAL = 0.12 (0) INPUT = 1.00



Structural component only
DWG# T-2007626

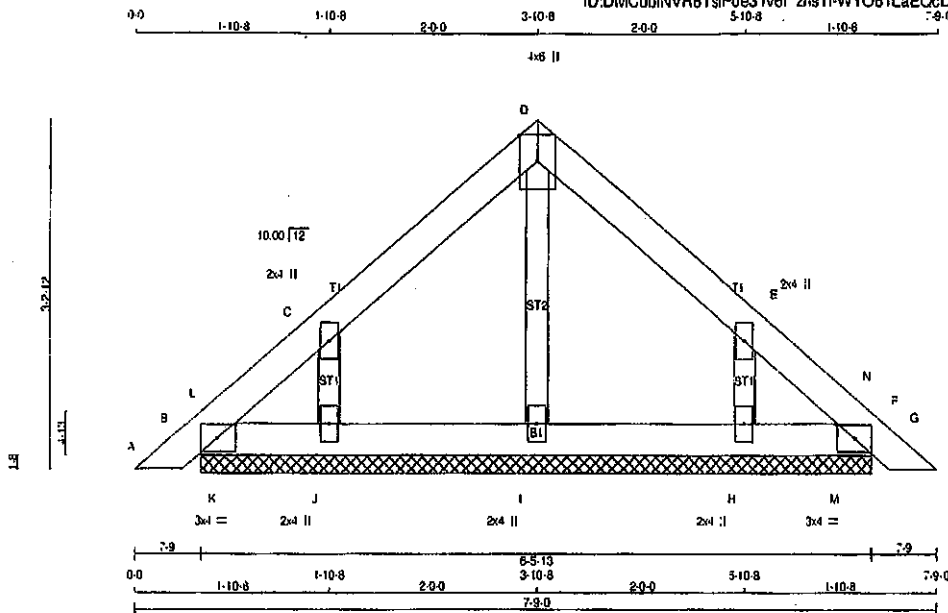

TOTAL WEIGHT = 2 X 22 = 45 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No. 2	SPF
D - G	2x4	DRY No. 2	SPF
B - F	2x4	DRY No. 2	SPF
ALL WEBS	2x3	DRY No. 2	SPF
ALL GABLE WEBS	2x3	DRY No. 2	SPF
DRY; SEASONED LUMBER.			

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (tablets in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	1.50	2.00
C	TMW+ w	MT20	2.0	4.0		
D	TTW+ p	MT20	4.0	6.0		Edge
E	TMW+ w	MT20	2.0	4.0		
F	TMB1-I	MT20	3.0	4.0	1.50	2.00
H, I, J						
H	BMW1+ w	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHOROS						WEBS					
MEMB.	MAX.	FACTORED	FACTORED				MEMB.	MAX.	FACTORED		
		FORCE	VERT.	LOAD	LC1	MAX.			FORCE	MAX	
		(LBS)		(PLF)	CSI (L)	UNBRAC			(LBS)	CSI (L)	
FR-TO			FROM	TO		LENGTH	FR-TO				
A-B	0	14	-91.8	-91.8	0.02 (1)	10.00	I-D	-111	0	0.02 (1)	
B-L	-71	0	-91.8	-91.8	0.00 (1)	6.25	J-C	-185	0	0.03 (1)	
L-C	-30	0	-91.8	-91.8	0.05 (1)	8.25	H-E	-185	0	0.03 (1)	
C-D	-47	0	-91.8	-91.8	0.05 (1)	6.25	K-L	0	9	0.00 (1)	
D-E	-47	0	-91.8	-91.8	0.05 (1)	6.25	M-N	0	9	0.00 (1)	
E-N	-30	0	-91.8	-91.8	0.05 (1)	8.25					
N-F	-71	0	-91.8	-91.8	0.00 (1)	8.25					
F-G	0	14	-91.8	-91.8	0.02 (1)	10.00					
B-K	0	44	-18.5	-18.5	0.01 (1)	10.00					
K-J	0	44	-18.5	-18.5	0.01 (4)	10.00					
J-I	0	27	-18.5	-18.5	0.02 (4)	10.00					
I-H	0	27	-18.5	-18.5	0.02 (4)	10.00					
H-M	0	44	-18.5	-18.5	0.01 (4)	10.00					
M-F	0	44	-18.5	-18.5	0.01 (1)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
OL = 6.0 PSF

BOT	CH.	LL	=	0.0	PSF
		DL	=	7.4	PSF

TOTAL LOAD	=	39.0	PSF
------------	---	------	-----

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010; NBCC 2015

THIS DESIGN COMPLIES WITH:

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF
LIVE LOAD

CS: TC=0.05/1.00 (C-D:1) , BC=0.02/1.00 (H-E:4) ,
WS=0.03/1.00 (C-J:1) , SS=0.07/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)		SHEAR		SECTION
	(PSI)		(PL)		(PL)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	618	354	1887	768	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.14 (E) INPUT = 0.90 ;
JSI METAL = 0.10 (C) INPUT = 1.00 ;




Structural component only
DWG# T-2007630

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	J1	21	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:01 2020 Page 1

ID:DMCubINVR6TsIFae31v8l_zns1f-u8TBW78oHNgUpbVf5dpsEbLZQFMuoV7BWCfEHzMFI

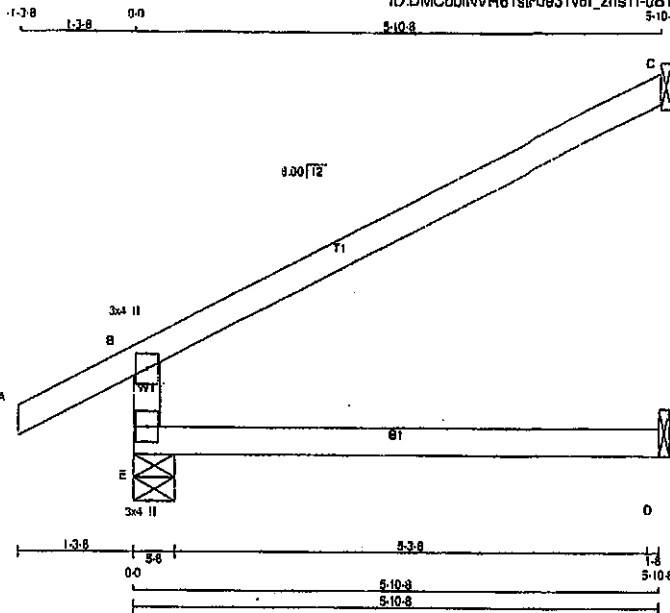

Scale = 1/2" = 1'-0"

CHORDS	SIZE	DRY	NO.2
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
E	325	0	0	0
C	202	0	0	0
D	45	0	0	0

SEE MITEX STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
E	369	257	0	0	111	0
C	139	113	0	0	28	0
D	36	0	0	0	36	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)	MAX. FACTORED VERT. LOAD (LC3)	MAX. FACTORED VERT. LOAD (LC4)	MAX. FACTORED VERT. LOAD (LC5)	MAX. FACTORED VERT. LOAD (LC6)	MAX. FACTORED VERT. LOAD (LC7)	MAX. FACTORED VERT. LOAD (LC8)	MAX. FACTORED VERT. LOAD (LC9)	MAX. FACTORED VERT. LOAD (LC10)
E-B		-61	0	0.0	0.0	0.13	(4)	7.81					
A-B		0	28	-91.8	-91.8	0.12	(1)	10.00					
B-C		-30	0	-91.8	-91.8	0.54	(1)	6.25					
E-D		0	0	-18.5	-18.5	0.13	(4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:	TOP CH.	LL	PSF
	DL	25.8	PSF
	DL	8.0	PSF
	DL	0.0	PSF
	DL	7.4	PSF
	TOTAL LOAD	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

55% OF 31.3 P.S.F. O.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.54 (1.00 (B-C:1), BC=0.13 (1.00 (D-E:4), WB=0.00 (1.00 (m-a:0), SS=0.24 (1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

PLATE GRIP(DRY) SHEAR SECTION	(PSI)	(PLI)	(PLI)
MAX MIN MAX MIN MAX MIN	618	354	1687
MT20	618	354	1687

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.19 (E), INPUT = 0.90
JSI METAL = 0.13 (B), INPUT = 1.00




Structural component only
DWG# T-2007598

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	J2S	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 2019 MTek Industries, Inc. Tue Apr 28 09:00:01 2020 Page 1

ID:DMCubINVR6TsIFoe31v8I_zns11-uBTBW78oHNgUpbVf5dpsEbLfhFOVoUrBWCCEIH2MFI

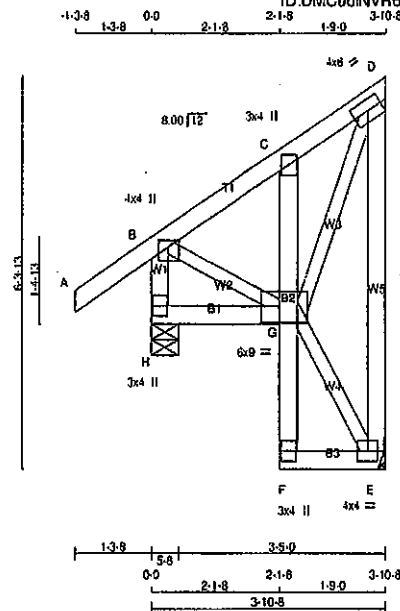

Scale = 1/4" = 1'-0"

TOTAL WEIGHT = 4 X 31 = 125 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
H - B	2x4	ORY	No.2
A - D	2x4	ORY	No.2
H - G	2x4	ORY	No.2
F - C	2x4	ORY	No.2
F - E	2x4	ORY	No.2
ALL WEBS	2x3	ORY	No.2
EXCEPT			
E - D	2x4	ORY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.25	2.00
C TMV+p	MT20	3.0	4.0		
D TMVW-1	MT20	4.0	8.0	2.00	2.75
E BMVW-1	MT20	4.0	4.0		
F BMV+p	MT20	3.0	4.0		
G BVMW-1	MT20	6.0	9.0	3.25	3.50
H BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
H	332	0	332	0
E	208	0	208	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1'-8".

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	232	188	0	0	0	88	0
E	145	95	0	0	0	50	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX CS1 (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)
FR-TO		FROM	TO		FR-TO		
H-B	-311 0	0.0	0.0 0.03 (1)	7.81	8-G	0 97	0.02 (1)
A-B	0 35	-91.8	-91.8 0.14 (6)	10.00	E-D	-188 0	0.08 (1)
B-C	-96 0	-91.8	-91.8 0.05 (1)	6.25	G-E	-7 0	0.00 (1)
C-D	-105 0	-91.8	-91.8 0.05 (1)	6.25	G-D	0 204	0.05 (1)
H-G	0 0	-18.5	-18.5 0.03 (4)	10.00			
F-G	0 15	0.0	0.0 0.01 (1)	10.00			
G-C	-202 0	0.0	0.0 0.01 (1)	7.81			
F-E	0 4	-18.5	-18.5 0.01 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.8	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

15% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN (LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.14 (A-B:5), BC=0.03 (G-H:4), WB=0.08 (D-E:1), SS=0.09 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MIN	MAX	MIN
MT20	618	354
	1687	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.22 (B) INPUT = 0.90
JSI METAL = 0.07 (C) INPUT = 1.00

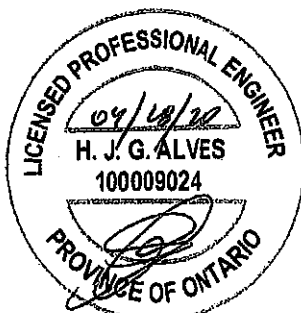

Structural component only
DWG# T-2007599



TOTAL WEIGHT = 2 X 33 = 65 lb

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
H-B	-308 0	0.0	0.0 (0.03 (1))	7.81	G-G	0 70	0.02 (11)
A-B	0 41	-91.8	-91.8 0.14 (5)	10.00	E-D	-185 0	0.08 (11)
B-C	-708 0	-91.8	-91.8 0.07 (11)	8.25	G-E	-13 0	0.00 (11)
C-D	-92 0	-91.8	-91.8 0.08 (11)	6.25	G-D	0 215	0.05 (11)
H-G	0 0	-18.5	-18.5 0.04 (4)	10.00			
F-G	0 12	0.0	0.0 0.02 (11)	10.00			
G-C	-216 0	0.0	0.0 0.02 (11)	7.81			
F-E	0 8	-18.5	-18.5 0.01 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	OL =	8.0	PSF
BOT CH.	LL =	0.0	PSF
	OL =	7.4	PSF
TOTAL LOAD =		39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BOBC 2018 , OBC 2012 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF
LIVE LOAD

ALLOWABLE DEFL.(LL)= L 360 (0.19)
CALCULATED VERT. DEFL.(LL) = L 999 (0.00")
ALLOWABLE DEFL.(TL)= L 360 (0.19)
CALCULATED VERT. DEFL.(TL) = L 999 (0.00")

CSI: TC=0.14/1.00 (A-B:5), BC=0.04/1.00 (G-H:4), WB=0.08/1.00 (D-E:1), SS(=0.09/1.00 (A-B:5))

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT REEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.24 (B) (INPUT = 0.90)
JSI METAL= 0.08 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007623

JOB NAME 408223	TRUSS NAME J21	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:03:53 2020 Page 1
ID:DMCubINVR6TsiFoe31v8I_zns11-hP0qniWUqmTmXUS8aPZUYh3VGyCuebnDgOW?oAzMEMo

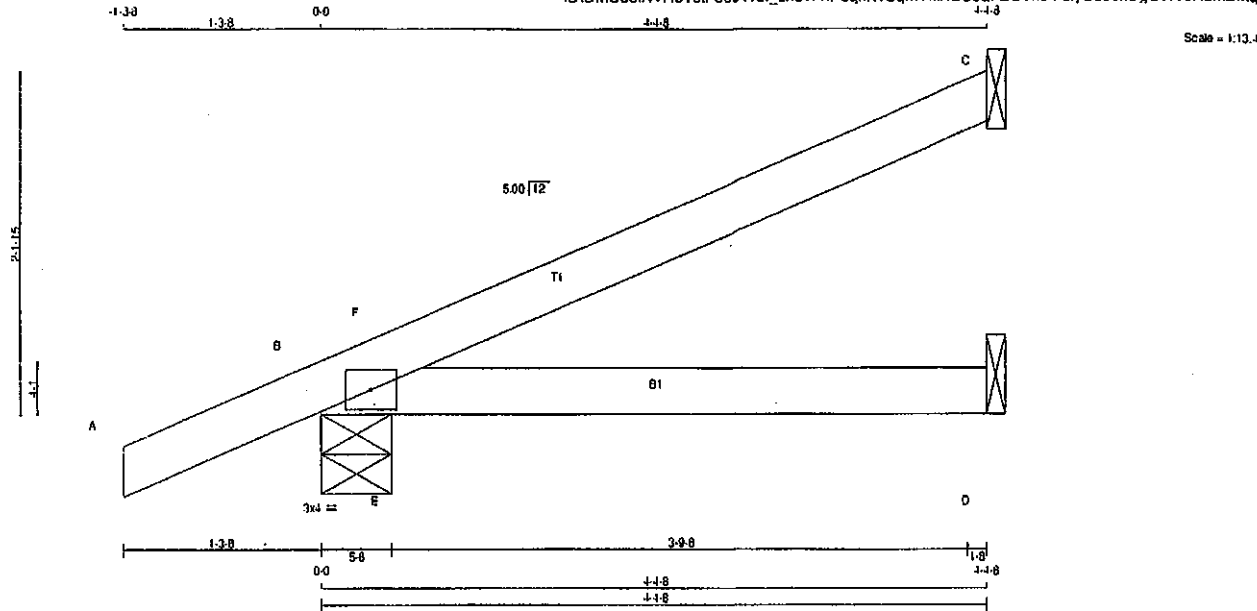

TOTAL WEIGHT = 4 X 12 = 48 lb

LUMBER
N. L. G. A. RULES
CHORDS SIZE DRY LUMBER No.2
A - C 2x4 DRY No.2
B - D 2x4 DRY No.2
DRY: SEASONED LUMBER.

PLATES (table in inches)
JT TYPE PLATES W LEN Y X
B TMS1-I MT20 3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
C	175	0	175	0	0	1-8	1-8	
B	365	0	365	0	0	5-8	5-8	
D	67	0	67	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOASE COMBINED		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	SNOW	LIVE	PERM	LIVE			
C	121	94	0	0	0	27	0
B	250	181	0	0	0	75	0
D	50	18	0	0	0	32	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)		FACTORED VERT. LOAD LC1 (PLF)		MAX. CS (LC)		WEBS MAX. FACTORED FORCE (LBS)		MAX. CS (LC)	
	FR-TO	FROM	FR-TO	FROM	FR-TO	FROM	FR-TO	FROM	FR-TO	FROM
A-B	0	23	-91.8	-91.8	0.12 (1)	10.00	E-F	235	7	0.00 (1)
B-F	-17	13	-91.8	-91.8	0.04 (4)	6.25				
F-C	-1	2	-91.8	-91.8	0.23 (1)	10.00				
B-E	0	0	-18.5	-18.5	0.16 (1)	10.00				
E-D	0	0	-18.5	-18.5	0.16 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CS: TC=0.23/1.00 (C-F:1), BC=0.16/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SS=0.19/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.26 (B) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007624


JOB NAME 408223	TRUSS NAME J22	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:03:54 2020 Page 1

ID:DMCubINVR6TstFoe31v6l zns1l-AbaD eX6b3bd9e1K874j4ubgIMZPN21Nv2FYKczMEMp

Scale = 1:27.0

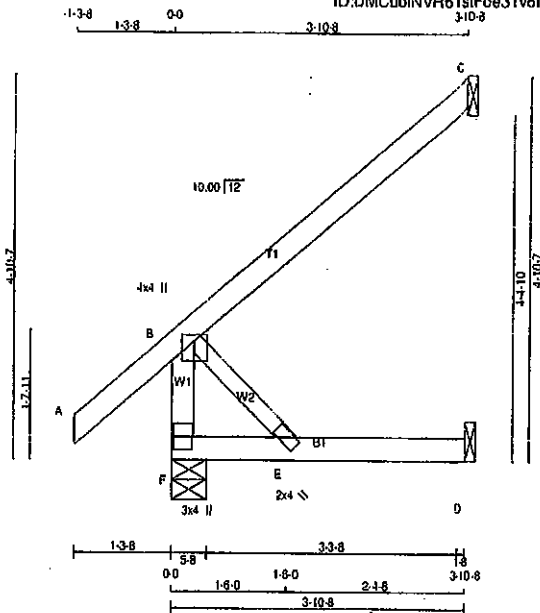

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W.	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
E	BMV+w	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	FACTORED GROSS REACTION	HORIZ	DOWN	MAXIMUM FACTORED GROSS REACTION	HORIZ	UP/LIFT	RECORD BRG IN-SX
F	341	0	341	0	0	5-8	5-8
C	178	0	178	0	0	1-8	1-8
D	36	0	40	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	239	170	0	0	0	69	0
C	122	99	0	0	0	23	0
D	29	0	0	0	0	29	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)	
F-B	-305	0	0.0	0.0	0.03 (1)	7.81	
A-B	0	41	-91.8	-91.8	0.14 (6)	10.00	
B-C	0	0	-91.8	-91.8	0.23 (1)	10.00	
F-E	0	0	-18.5	-18.5	0.08 (4)	10.00	
E-D	0	0	-18.5	-18.5	0.08 (4)	10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8	PSF
	DL = 8.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. CGC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) =	L/360 (0.19")
CALCULATED VERT. DEFL.(LL) =	L/999 (0.00")
ALLOWABLE DEFL.(TL) =	L/360 (0.19")
CALCULATED VERT. DEFL.(TL) =	L/999 (0.01")

CSI: TC=0.23/1.00 (B-C:1), BC=0.09/1.00 (D-E:1), WB=0.00/1.00 (B-E:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MT20	618	354
	1667	788
	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (B) INPUT = 0.90
JSI METAL = 0.08 (B) INPUT = 1.00




Structural component only
DWG# T-2007625

JOB NAME 408224	TRUSS NAME J40	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:52 2020 Page 1
ID:DMCubINVR6TstIF0831v61 zns11-6uTN2C71 PHH5SGSGJGMwHM_XXOqKBNC5Jfy4zME7r

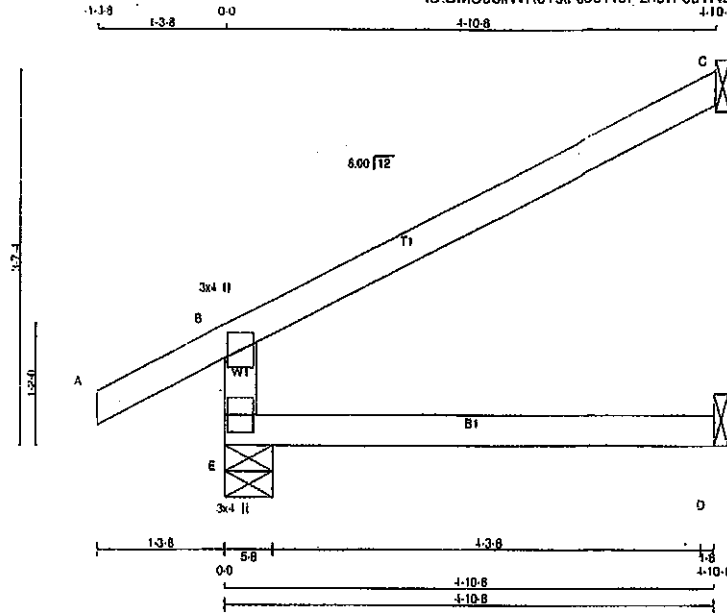

Scale = 1:20.5

TOTAL WEIGHT = 2 X 14 = 28 LB

LUMBER

N. L. G. A. RULES			
CHORDS	SIZE		LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ
JT	458	0	458	0
E	168	0	168	0
C	168	0	168	0
D	38	0	42	0

SEE MITEK STANDARD DETAIL 697791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
E	320	225	0	0	0	95	0
C	116	94	0	0	0	22	0
D	30	0	0	0	0	30	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORIZ. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED HORIZ. LOAD (PLF)
E-B		-404	0	0.0	0.08 (4)	7.81			
A-B		0	28	-91.8	-91.8	0.12 (1)	10.00		
B-C		-25	0	-91.8	-91.8	0.37 (1)	6.25		
E-D		0	0	-18.5	-18.5	0.09 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.37 1.00 (B-C:1), 8C=0.09/1.00 (D-E:4),
WB=0.00/1.00 (in a 0), SSI=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	518 354	1887 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (E) (INPUT = 0.90)
JSI METAL= 0.11 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007657

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	J41	5	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:54 2020 Page 1

ID:DMCubINVR6TslFoe31v6I zns11-3Hb7Tu8HW1XPKAQqNkqj_LMmiLemEngIPoM1zzME7p

Scale = 1:17.8

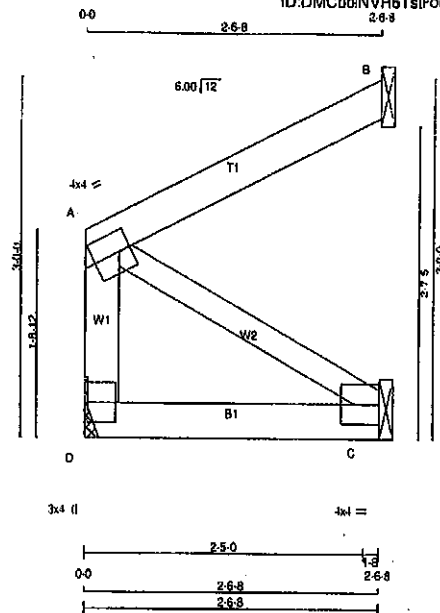

TOTAL WEIGHT = 5 X 10 = 49 lb
(M/F)

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
D - A	2x4 DRY	No.2	SPF
A - B	2x4 DRY	No.2	SPF
D - C	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
DRY: SEASONED LUMBER.			

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	4.0	4.0	2.00	1.25
C	BMV1-t	MT20	4.0	4.0	2.00	Edge
D	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING DESIGNER									
BEARINGS									
FACTORED				MAXIMUM FACTORED		INPUT		REQ'D	
GROSS REACTION				GROSS REACTION		BRG		BRG	
JT	VERT	HORZ		DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
D	139	0		139	0	0		MECHANICAL	
B	117	0		117	0	0	1-8	1-8	
C	23	0		25	0	0	1-8	1-8	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	98	65 0	0 0	0 0	0 0	33 0	0 0
B	80	65 0	0 0	0 0	0 0	15 0	0 0
C	18	0 0	0 0	0 0	0 0	18 0	0 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PL)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	UNBRACED LENGTH FR-TO
D-A	-117 0	0.0	0.0 0.01 (1)	A-C	0 0	0.00 (1)	7.81
A-B	0 0	-91.8	-91.8 0.10 (1)				10.00
D-C	0 0	-18.5	-18.5 0.03 (4)				10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.0 PSF
CL = 8.0 PSF
BOT CH. LL = 0.0 PSF
CL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./G

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2010
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFLECT (TL) = L/360 (0.19")
CALCULATED VERT. DEFLECT (TL) = L/999 (0.00")

CSI: TC=0.10/1.00 (A-B:1), BC=0.03/1.00 (C-D:4),
WB=0.00/1.00 (A-C:1), SS=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1887 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.07 (A) INPUT= 0.90)
JSI METAL= 0.02 (A) INPUT= 1.00)



Structural component only
DWG# T-2007658



TOTAL WEIGHT = 2 X 16 = 31 lb

N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR
E - A	2x4	DRY	No.2	SPF
A - B	2x4	DRY	No.2	SPF
E - C	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	4.0	4.0	2.00	1.25
D	BMW+w	MT20	2.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

BEARINGS

	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX
E	301	0	301	0	0	MECHANICAL
B	250	0	250	0	0	1-8
C	50	0	57	0	0	1-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1'-8".

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B.C.

1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	213	140 0	0 0	0 0	0 0	73 0	0 0
B	172	140 0	0 0	0 0	0 0	33 0	0 0
C	40	0 0	0 0	0 0	0 0	40 0	0 0

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

TOTAL LOAD CASES: 14)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)
FR-TO		FROM TO			FR-TO		
E-A	-250 0	0.0 0.0	0.03 (1)	7.81	A-D	0 0	0.00 (1)
A-B	0 0	-91.8 -91.8	0.48 (1)	10.00			
E-D	0 0	-18.5 -18.5	0.13 (4)	10.00			
D-C	0 0	-18.5 -18.5	0.16 (4)	10.00			

SPECIFIED LOADS:			
TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9.
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF
LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.48/1.00 (A-B:1) , BC=0.16/1.00 (C-D:4) ,
WB=0.00/1.00 (A-D:1) , SSI=0.17/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1658

PLATE PLACEMENT TOL. = 0.250 Inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.15 (A) (INPUT = 0.90)
JSI METAL = 0.04 (A) (INPUT = 1.00)



Structural component only
DWG# T-2007659

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C40	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 8 Oct 2019 Mitek Industries, Inc. Tue Apr 28 10:19:42 2020 Page 1					
ID:DMCubINVR6TstFoe31v6l zns11-Pzsbyo7ILL18uKVXgD50VpshpV5QUojvXujdzME8?					
Scale = 1:17.8					

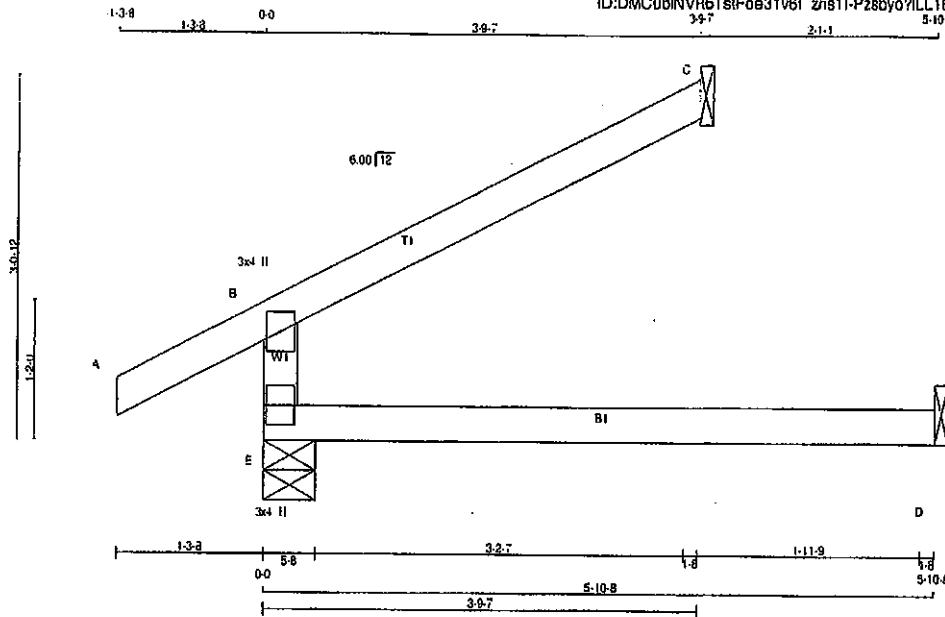

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2
DRY, SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BRG
E	405	0	405	0	0	5-8	5-8		
C	130	0	130	0	0	1-8	1-8		
D	45	0	50	0	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	286	190 0	0 0	0 0	0 0	96 0	0 0
C	90	73 0	0 0	0 0	0 0	17 0	0 0
D	36	0 0	0 0	0 0	0 0	36 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE	VERT. LOAD	LC1 MAX	MEMB.	FORCE	MAX	MAX
	(LBS)	(PLF)	CSI (LC)		(LBS)	CSI (LC)	
FR-TO		FROM TO	UNBRAC LENGTH	FR-TO			
E-B	-342	0	0.0	0.0	0.13 (4)	7.61	
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00	
B-C	-19	0	-91.8	-91.8	0.22 (1)	6.25	
E-D	0	0	-18.5	-18.5	0.13 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.22/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (no:0), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1857 798 1887 1658	

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (E), INPUT = 0.90)
JSI METAL= 0.09 (B), INPUT = 1.00)



Structural component only
DWG# T-2007648

Tamareck Roof Truss, Burlington

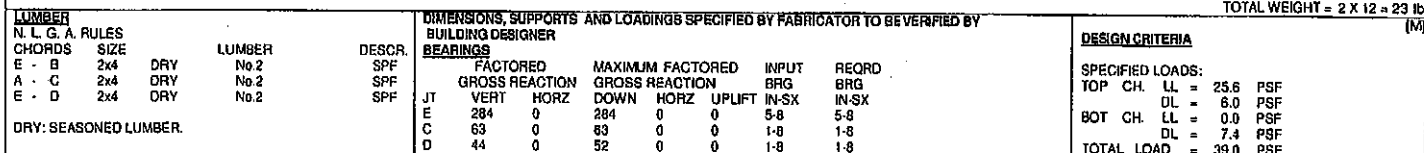

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
<u>BEARINGS</u>							
FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG		
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
	284	0	284	0	0	5-8	5-8
C	63	0	83	0	0	1-8	1-8
D	44	0	52	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C. D.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E. C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.


LOADING

TOTAL LOAD CASES: (7)

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LCI	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	1-11-4	7	1	12	BACK	VERT	TOTAL	...	CI
G	3-11-4	1	1	...	BACK	VERT	TOTAL	...	CI

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED



DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018 , OBC 2012 . ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

DESIGN REQUIREMENTS
-OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF
LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4),
WB=0.00/1.00 (inv:0), SS=0.09/1.00 (A-B:1)

DOL LUMBER=0.98 NAIL=0.98 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg

JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)


JOB NAME 408224	TRUSS NAME C42	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:45 2020 Page 1

ID:DMCubINVR6tsiFoe31v6l zns1i-pYYkap1eeGPhnE6LLej7RUC2j9wh9SMBv7NC zME7y

Scale = 1:18.2

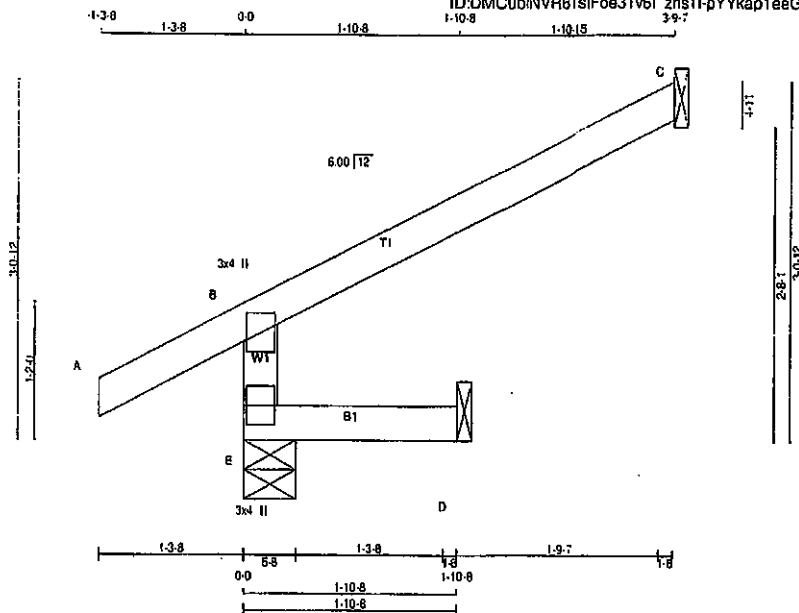

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE		LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY, SEASONED LUMBER.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	FACTORED GROSS REACTION	VERY	HORZ	MAXIMUM FACTORED GROSS REACTION	DOWN	HORZ	INPUT BRG
E	381	0	0	381	0	0	5-8
C	130	0	0	130	0	0	1-8
D	18	0	0	17	0	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINTS C, D

UNFACTORED REACTIONS							
JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD
E	250	190	0	0	0	0	80
C	90	73	0	0	0	0	17
D	12	0	0	0	0	0	12

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS (I/C)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (I/C)	UNBRACED LENGTH FR-TO
E-B	-342	0	0.0	0.0	0.01	(4)	7.81
A-B	0	28	-91.8	-91.8	0.13	(5)	10.00
B-C	-19	0	-91.8	-91.8	0.22	(1)	6.25
E-D	0	0	-18.5	-18.5	0.02	(4)	10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.22(1.00 (B-C:1), BC=0.02(1.00 (D-E:4), WB=0.09(1.00 (max:0), SS=0.15(1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES			
PLATE GRIP(DRY)	SHEAR	SECTION	
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	818	354	1687
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.14 (E) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007650

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	C43	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:19:46 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_znsf1-lk66o92GPaxYNxplv39yff10Q6VqQcIVq9sxlRzME7x

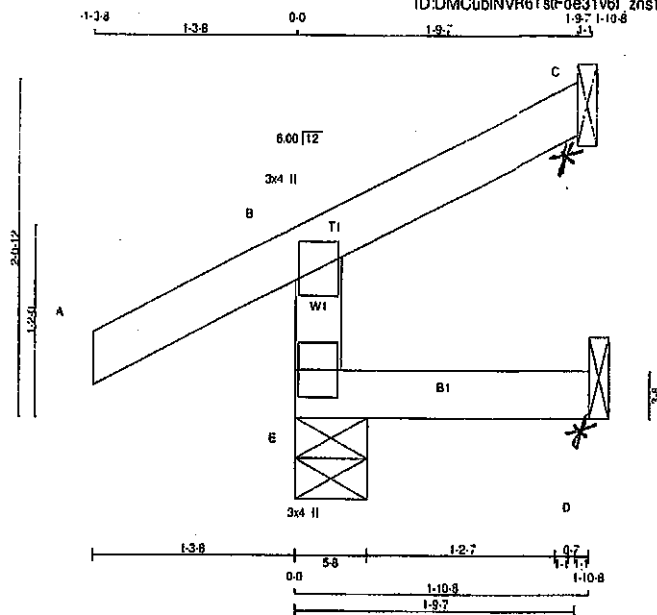

Scale = 1/16" = 1'-0"

TOTAL WEIGHT = 3 X 7 = 21 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No. 2
A - C	2x4	DRY	No. 2
E - D	2x4	DRY	No. 2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX
E	271	0	271	0	0	5-8	5-8		
C	45	0	45	0	-23	1-8	1-8		
D	8	0	17	0	-2	1-8	1-8		

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) E, C

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS		MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
E	188	141	0	0.0	0.0	47	0	0
C	31	24	-18	0.0	0.0	7	0	0
D	7	0	-8	0.0	0.0	12	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		W E B S		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRACED LENGTH	MEMB.	FORCE (LBS)	MAX. CS1 (LC)
E-B	-244	0	0.0	0.0 0.04 (5)	7.81		
A-B	0	28	-91.8	-91.8 0.12 (1)	10.00		
B-C	-17	0	-91.8	-91.8 0.09 (1)	6.25		
E-D	0	0	-18.5	-18.5 0.04 (5)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.8	PSF
	OL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	OL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN. G/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5).
WB=0.00/1.00 (max), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
	MAX	MIN	MAX
MT20	618	354	1687
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (EI) INPUT = 0.90
JSI METAL = 0.07 (EI) INPUT = 1.00




Structural component only
DWG# T-2007651

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C44	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:47 2020 Page 1
ID:DMCubINVR6TslFoe31v61_zns1l-mxgU7V3uAHP 5OUTmhBCsZXYWqD93ye2pcUHzME7w

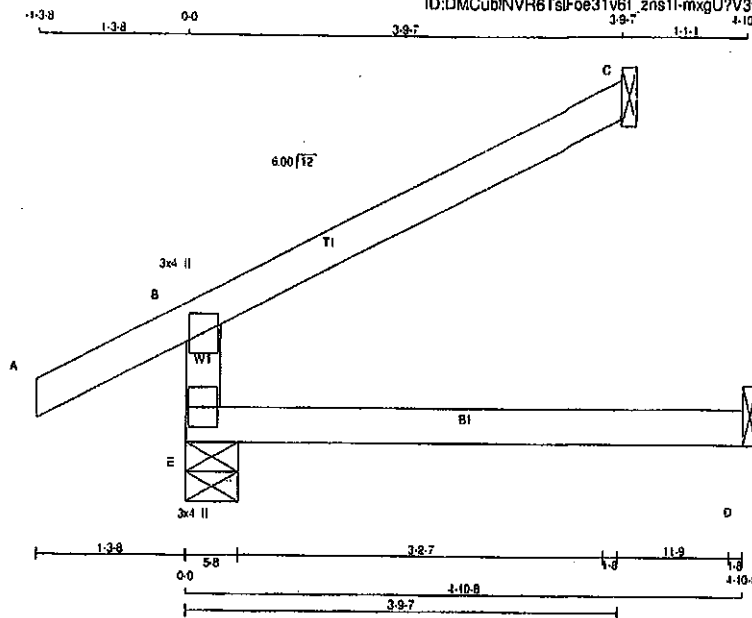

Scale = 1:17.5

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
E	394	0	394	0
C	130	0	130	0
D	38	0	42	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	277	190	0	0	0	87	0
C	90	73	0	0	0	17	0
D	30	0	0	0	0	30	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. FURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM	TO	FR-TO		FROM	TO
E-B	-342	0	0.0	0.0	0.0	0.0	7.81
A-B	0	28	-91.8	-91.8	0.12	11	10.00
B-C	-19	0	-91.8	-91.8	0.22	11	6.25
E-D	0	0	-18.5	-18.5	0.09	4	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.22:1.00 (B-C:1), BC=0.09:1.00 (D-E:4), WB=0.00:1.00 (max:0), SSI=0.15:1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSD) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.14 (E) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)

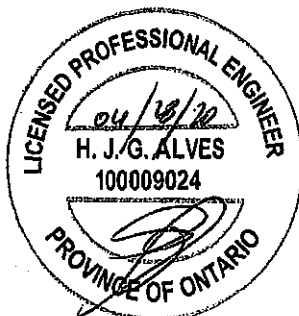


Structural component only
DWG# T-2007652

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	C45	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:48 2020 Page 1

ID:DMCubINVR6TslFoe31v6l_zns11-E7DsCr3WxBnFcFyp1UCQI46kwwAMuWCoHTL1pJzME7v

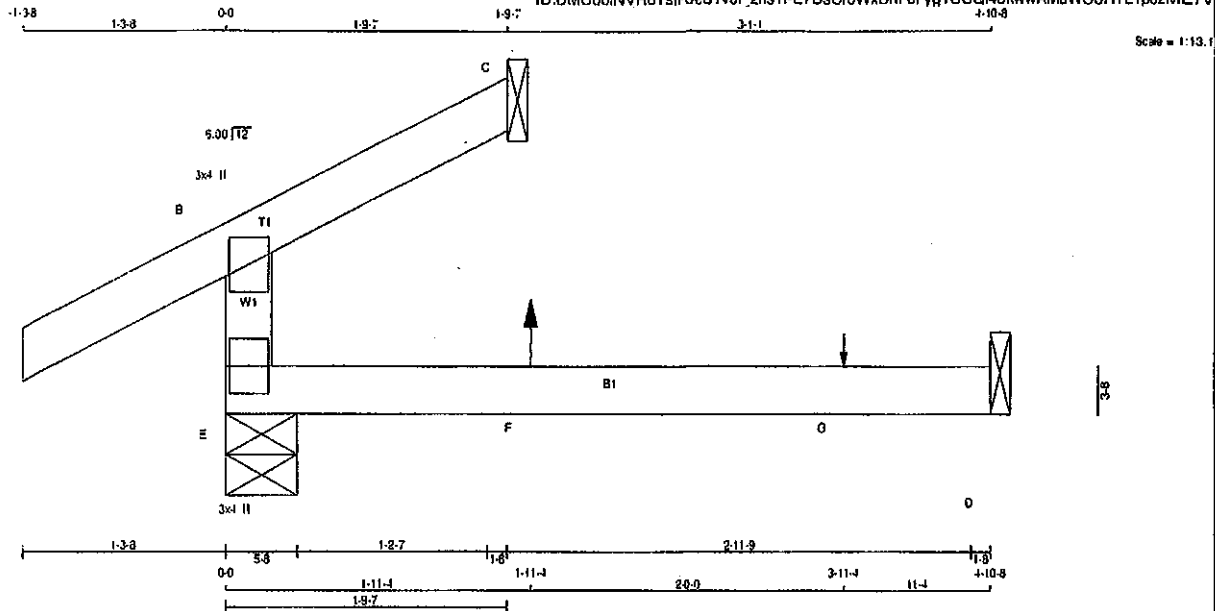

TOTAL WEIGHT = 2 X 10 = 21 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT
E	282	0	282	0	5-8
C	55	0	55	0	1-8
D	35	0	44	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
JT	1ST LOASE	SNOW	MAX. MIN. LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	198	137	0	0	0	81	0
C	39	21	0	0	0	18	0
D	29	0	4	0	0	31	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (7)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
E-B	-235	0	0.0	0.0	0.07 (4)	7.81	
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00	
B-C	-13	5	-91.8	-91.8	0.07 (5)	8.25	
E-F	0	0	-18.5	-18.5	0.10 (4)	10.00	
F-G	0	0	-18.5	-18.5	0.10 (4)	10.00	
G-D	0	0	-18.5	-18.5	0.10 (4)	10.00	

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE
F	1-11.4	7	1	12	BACK	VERT	TOTAL
G	3-11.4	1	1	1	BACK	VERT	TOTAL

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.12(1.00) (A-B:1), BC=0.10(1.00) (D-E:4), WB=0.00(1.00) (A-D:0), SS=0.09(1.00) (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.10 (E) INPUT = 0.90
JSI METAL=0.07 (D) INPUT = 1.00




Structural component only
DWG# T-2007653



TOTAL WEIGHT = 7 lb
(M/F)

JSI GRIP= 0.08 (D) INPUT = 0.90
JSI METAL= 0.05 (A) INPUT = 1.00




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	C47	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:50 2020 Page 1

ID:DMCubINVR6TslFoe31v6f zns1I-AWLddX5mSo1zrY638uEuqVB5sks7MQI5knq8uCzME76

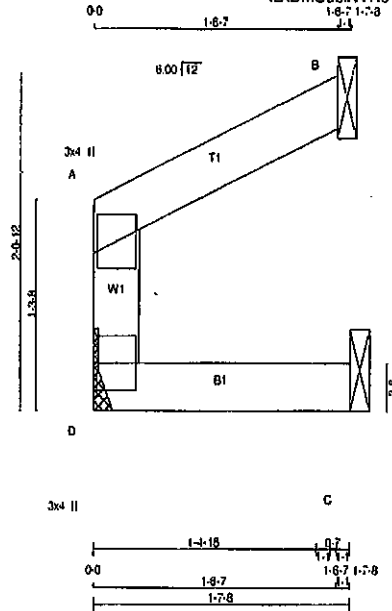

Scale = 1:13.1

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
D - A	2x4 DRY	No.2	SPF
A - B	2x4 DRY	No.2	SPF
O - C	2x4 DRY	No.2	SPF
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	V X
A	TMV+p	MT20	3.0	4.0	
O	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
D	88	0	88	0
B	67	0	67	0
C	19	0	19	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	61	39	0	0	0	0	21	0
B	46	37	0	0	0	0	9	0
C	14	2	0	0	0	0	12	0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD LC1	MAX. FACTORED	MEMB.	MAX. FACTORED	VERT. LOAD LC1
	FORCE (LBS)	(PLF)	CS1 (LC)	UNBRAC		FORCE (LBS)	CS1 (LC)
FR-TO		FROM TO	LENGTH	FR-TO			
D-A	-74	0	0.0	0.0	0.01 (1)	7.81	
A-B	-2	0	-91.8	-91.8	0.03 (1)	10.00	
D-C	0	0	-18.5	-18.5	0.01 (4)	10.00	

TOTAL WEIGHT = 5 b (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL (LL) = L/360 (0.19')
CALCULATED VERT. DEFL (LL) = L/999 (0.00')
ALLOWABLE DEFL (TL) = L/360 (0.19')
CALCULATED VERT. DEFL (TL) = L/999 (0.00')

CS: TC=0.03, 1.00 (A-B:1), BC=0.01, 1.00 (C-D:4).
WB=0.00, 1.00 (min:0), SS=0.05, 1.00 (A-B:1)

OOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1687 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.03 (D) INPUT = 0.90
JSI METAL = 0.02 (A) INPUT = 1.00



Structural component only
DWG# T-2007655

LUL/LUS/LJS/HUS/HHUS/HGUS

SIMPSON
Strong-Tie

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.

Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:

- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:

- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on p. 126.




Double-Shear
Nailing
Top View




Double-Shear
Nailing
Side View;
Do not
bend tab




Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,580

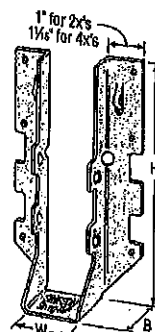


LUS28




LU26L

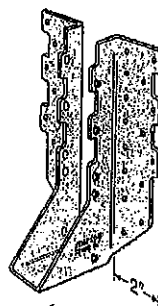


HUS210
(HUS26, HUS28,
and HHUS similar)



HGUS28-2




HHUS210-2



LJS26DS

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

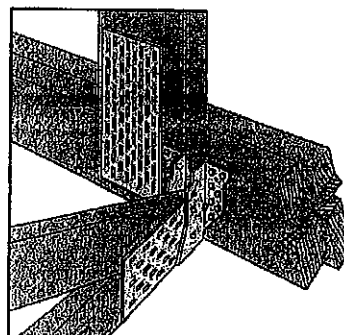

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options information on pp. 125–127.


HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
$W < 2"$	Bevel or square cut	0.62 of table value	0.46 of table value
$2" < W < 6"$	Bevel cut	0.67 of table value	0.41 of table value
$2" < W < 6"$	Square cut	0.46 of table value	0.41 of table value
$W > 6"$	Bevel cut	0.75 of table value	0.41 of table value

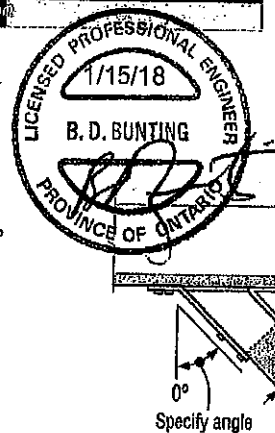**Top View HHUS Hanger Skewed Right**

(joist must be bevel cut)
All joist nails installed on the outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _a ³	Header	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb.	(K _D = 1.00) lb.	(K _D = 1.15) lb.	(K _D = 1.00) lb.
Single 2x Sizes											
LUS24	18	1 1/8	3 1/2	1 1/2	2 1/4	(4) 10d	(2) 10d	710	1625	645	1156
								316	723	287	514
								360	1020	320	725
LU24L	22	1 1/8	3	1 1/2	2 1/8	(4) 10d	(2) 10d x 1 1/2"	160	454	142	322
								720	1606	646	1140
								320	714	287	507
LU26L	22	1 1/8	5	1 1/2	4 1/2	(6) 10d	(4) 10d x 1 1/2"	1420	2170	1290	1630
								632	965	574	725
								2706	4940	2085	3875
SS LUS26	18	1 1/8	4 1/2	1 1/2	3 3/4	(4) 10d	(4) 10d	1130	2197	920	1724
								2055	4265	1480	4115
								914	1897	649	1831
HUS26	16	1 1/8	5 1/2	3	3 3/8	(14) 16d	(6) 16d	2685	6625	2685	5700
								1196	2951	1196	2535
								1140	2185	1020	1550
LJS26DS	18	1 1/8	5	3 1/2	4 1/2	(16) 16d	(6) 16d	507	972	454	689
								1420	2520	1290	1790
								632	1121	574	796
SS LUS28	18	1 1/8	6 1/2	1 1/2	3 3/4	(6) 10d	(4) 10d	3605	5365	2675	4345
								1604	2388	1190	1933
								3310	7675	3310	6900
HUS28	16	1 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	1474	3419	1474	3073
								1140	2495	1020	1770
								507	1110	454	787
SS LUS210	18	1 1/8	7 1/8	1 1/2	3 3/4	(8) 10d	(4) 10d	1420	2785	1290	2210
								632	1239	574	983


1. Factored uplift resistances have been increased 16% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_a is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.182" dia. x 3 1/2" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _a ¹	Header	Joist	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN	(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN
Double 2x Sizes											
LUS24-2	18	3 1/8	3 1/8	2	1 1/2	(4) 16d	(2) 16d	835 3.71	2020 8.99	590 2.62	1435 6.38
LUS26-2	18	3 1/8	4 1/8	2	4	(4) 16d	(4) 16d	1720 7.65	2595 11.54	1545 6.87	1920 8.54
HHUS26-2	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	2850 12.68	7335 32.63	2065 9.20	5205 23.15
HGUS26-2	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
LUS28-2	18	3 1/8	7	2	4	(6) 16d	(4) 16d	1720 7.65	3325 14.79	1545 6.87	2575 11.45
HHUS28-2	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3765 16.75	8940 39.77	2675 11.90	6345 28.22
HGUS28-2	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
LUS210-2	18	3 1/8	9	2	6	(8) 16d	(8) 16d	2580 11.48	4500 20.02	2320 10.32	3195 14.21
HHUS210-2	14	3 1/8	9 1/8	3	8	(30) 16d	(10) 16d	4670 20.77	9690 42.97	4235 18.84	7000 31.14
HGUS210-2	12	3 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	6840 30.43	14015 62.34	4855 21.60	10270 45.69
Triple 2x Sizes											
HGUS26-3	12	4 1/8	5 1/2	4	4 1/8	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
HGUS28-3	12	4 1/8	7 1/4	4	6 1/8	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d	4670 20.77	9690 43.02	4235 18.84	6865 30.54
HGUS210-3	12	4 1/8	9 1/4	4	8 1/8	(46) 16d	(16) 16d	6840 30.43	14645 65.14	4855 21.60	10400 46.26
Quadruple 2x Sizes											
HGUS26-4	12	6 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
HGUS28-4	12	6 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
HHUS210-4	14	8 1/8	8 1/8	3	7 1/8	(30) 16d	(10) 16d	4670 20.77	10155 45.17	4235 18.84	7210 32.07
HGUS210-4	12	6 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	6840 30.43	14645 65.14	4855 21.60	10400 46.26
HGUS212-4	12	6 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	7840 33.98	14995 66.70	5425 24.13	10645 47.35
HGUS214-4	12	6 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	10130 45.06	16400 72.95	7195 32.00	11645 51.80
4x Sizes											
LUS46	18	3 1/8	4 1/8	2	3 1/8	(4) 16d	(4) 16d	1720 7.65	2595 11.54	1545 6.87	1920 8.54
HHUS46	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	2540 11.30	7335 32.63	2065 9.20	5205 23.15
HGUS46	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
LUS48	18	3 1/8	6 1/8	2	3 1/8	(6) 16d	(4) 16d	1720 7.65	3325 14.79	1545 6.87	2575 11.45
HHUS48	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3765 16.75	8940 39.77	2675 11.90	6345 28.22
HGUS48	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
LUS410	18	3 1/8	8 1/8	2	5 1/8	(8) 16d	(8) 16d	2580 11.48	4500 20.02	2320 10.32	3195 14.21
HGUS410	12	3 1/8	9	4	8 1/8	(46) 16d	(16) 16d	6840 30.43	14015 62.34	4855 21.60	10270 45.69
HGUS412	12	3 1/8	10 1/8	4	10 1/8	(66) 16d	(20) 16d	7840 33.98	14995 66.70	5425 24.13	10645 47.35
HGUS414	12	3 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	10130 45.06	16400 72.95	7195 32.00	11645 51.80



Plated Truss Connectors

See footnotes on p. 258.

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1/4". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

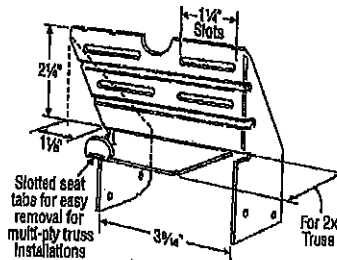


TC24
U.S. Patent 4,932,173

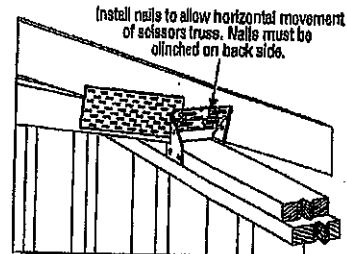


Typical TC24 Installation

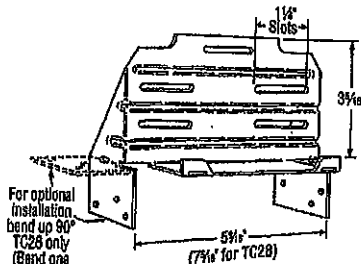

TC26
(TC28 Similar)

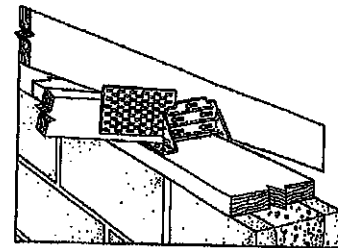

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer (8", 10", 12" Wall Installation Similar)

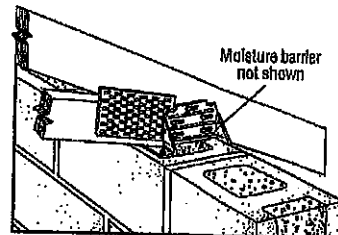

Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fk-L	S-P-F
			Uplift (K _o =1.15)	Uplift (K _o =1.15)
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(6) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fk-L	S-P-F
			Uplift (K _o =1.15)	Uplift (K _o =1.15)
TC26	(5) 10d	(6) 10d x 1 1/2"	810	660
	(5) 10d	(6) 10d	930	660

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.

2. Grout strength is 15 MPa minimum.

3. Optional TC26 Installation with 10d nails requires minimum 3" top plate thickness.

4. TC26 fastened to grouted concrete block with (6) - 3/8" x 2 1/4" Titen screws has a factored uplift resistance of 275 lb.



(800) 999-5099
strongtie.com

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_D = 1.15$)					
		To Rafters/ Truss	To Plates	To Studs	D.Fir-L			S-P-F		
					Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(5) 8d x 1½"	(4) 8d	—	740	685	300	880	485	215
					3.29	3.05	1.33	3.02	2.16	0.98
SS H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
					3.58	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	160	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	265	615	125	190
					3.29	0.80	1.18	2.74	0.56	0.85
H6	16	—	(3) 8d	(3) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(3) 8d	1390	670	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS H8 ³	18	(5) 10d x 1½"	(5) 10d x 1½"	—	1120	—	—	1025	—	—
					4.98	—	—	4.56	—	—
SS H10A ³	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	565	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.54	1.36
H10A-2	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1835	1275	430	1645	880	305
					8.16	5.67	1.91	7.32	3.91	1.36
H10S ³	18	(3) 8d x 1½"	(3) 8d x 1½"	(3) 8d	1465	795	315	1040	565	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2½"	(6) 16d x 2½"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	[1] (12) 8d x 1½"	(13) 8d	—	2390	855	320	1805	610	230
		[2] (12) 8d x 1½"	(15) 8d	—	10.63	3.80	1.42	8.03	2.71	1.02
					2390	855	320	1805	610	230
TSP	18	(9) 10d x 1½"	(6) 10d x 1½"	—	10.63	3.80	1.42	8.03	2.71	1.02
					1295	440	—	920	310	—
					5.76	1.98	—	4.09	1.38	—
		(9) 10d x 1½"	(6) 10d	—	1560	440	—	1105	310	—
					6.94	1.98	—	4.92	1.38	—

- Factored resistances have been increased 15% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 595 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HIECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 6/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1½" nails into the top plates and (3) 8d x 1½" nails into the lowest three flange holes into the truss bottom chord is 485 lb. (2.20 kN).
- Nails: 16d x 2½" = 0.182" dia. x 2½" long, 10d = 0.148" dia. x 3" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long, 8d x 1½" = 0.131" dia. x 1½" long. See pp. 27–28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

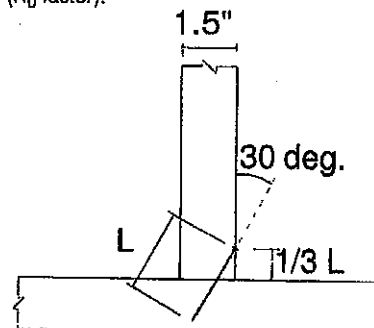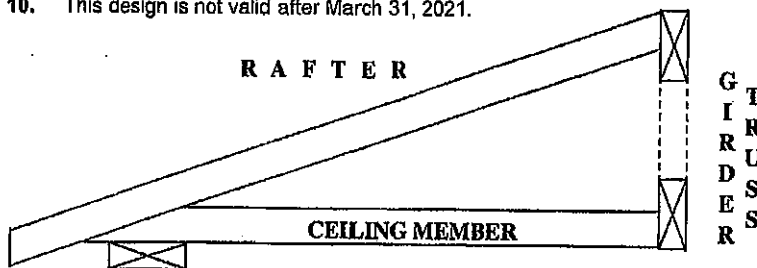


TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (In)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek

MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to wind or earthquake load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

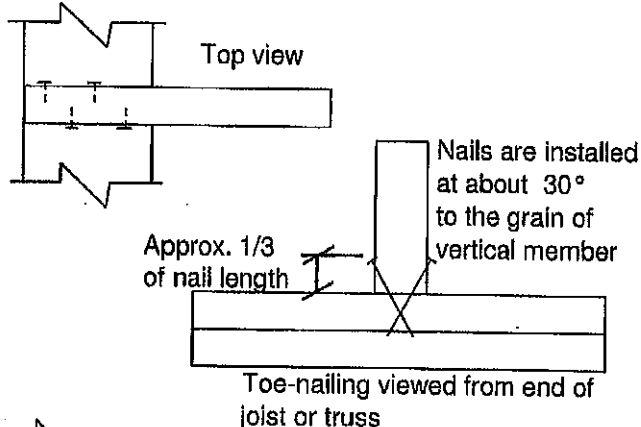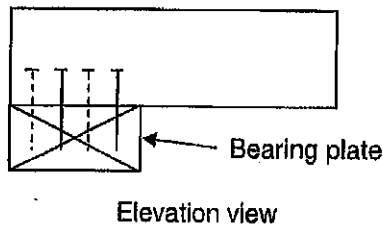

Toe-nailing on 2x4 Bearing Plate

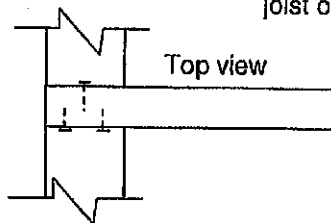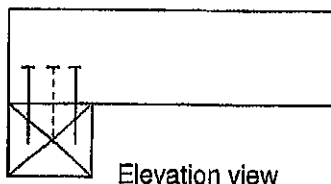


MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7




December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

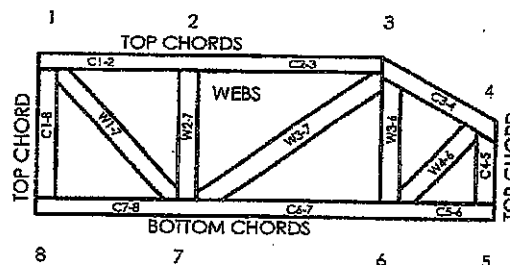

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MIT-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane of joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

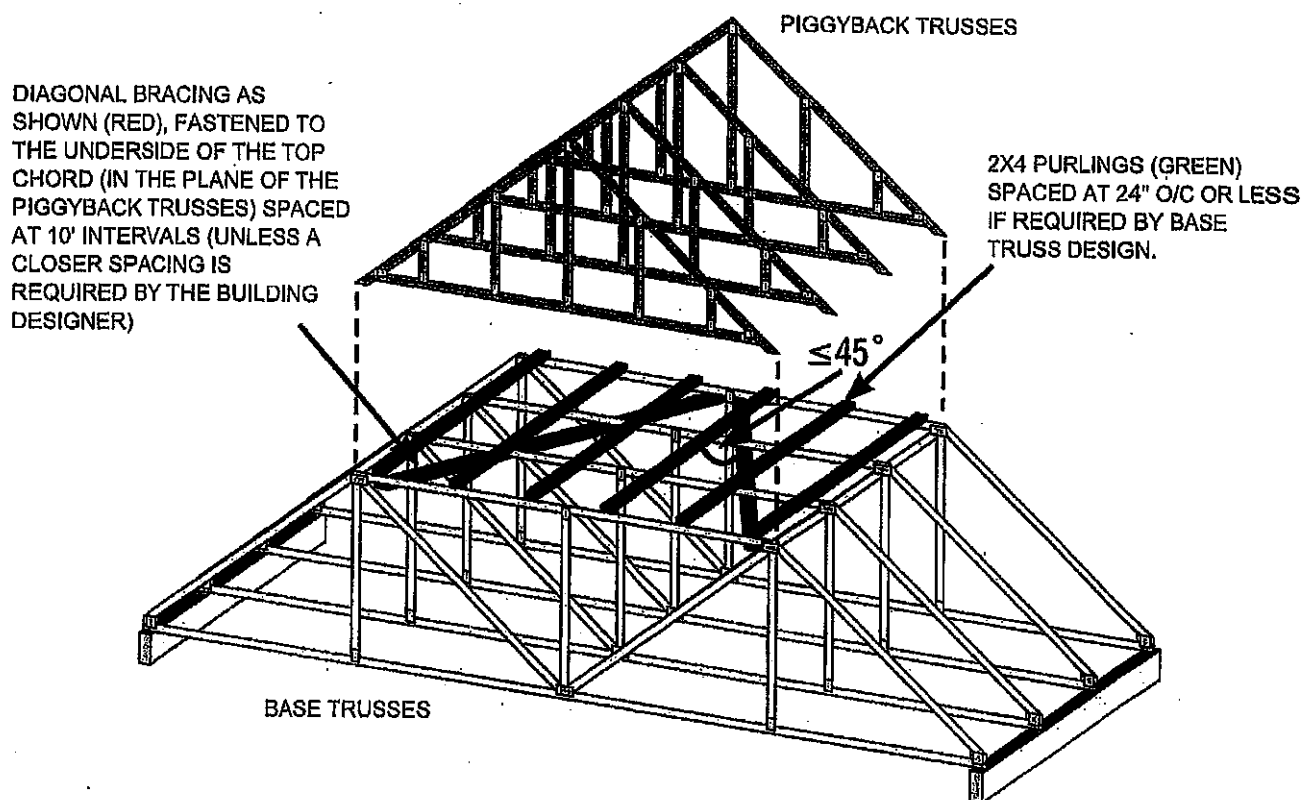

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufacturer's responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1900213

Feb 09, 2018