


10/12 roof pitch unless noted

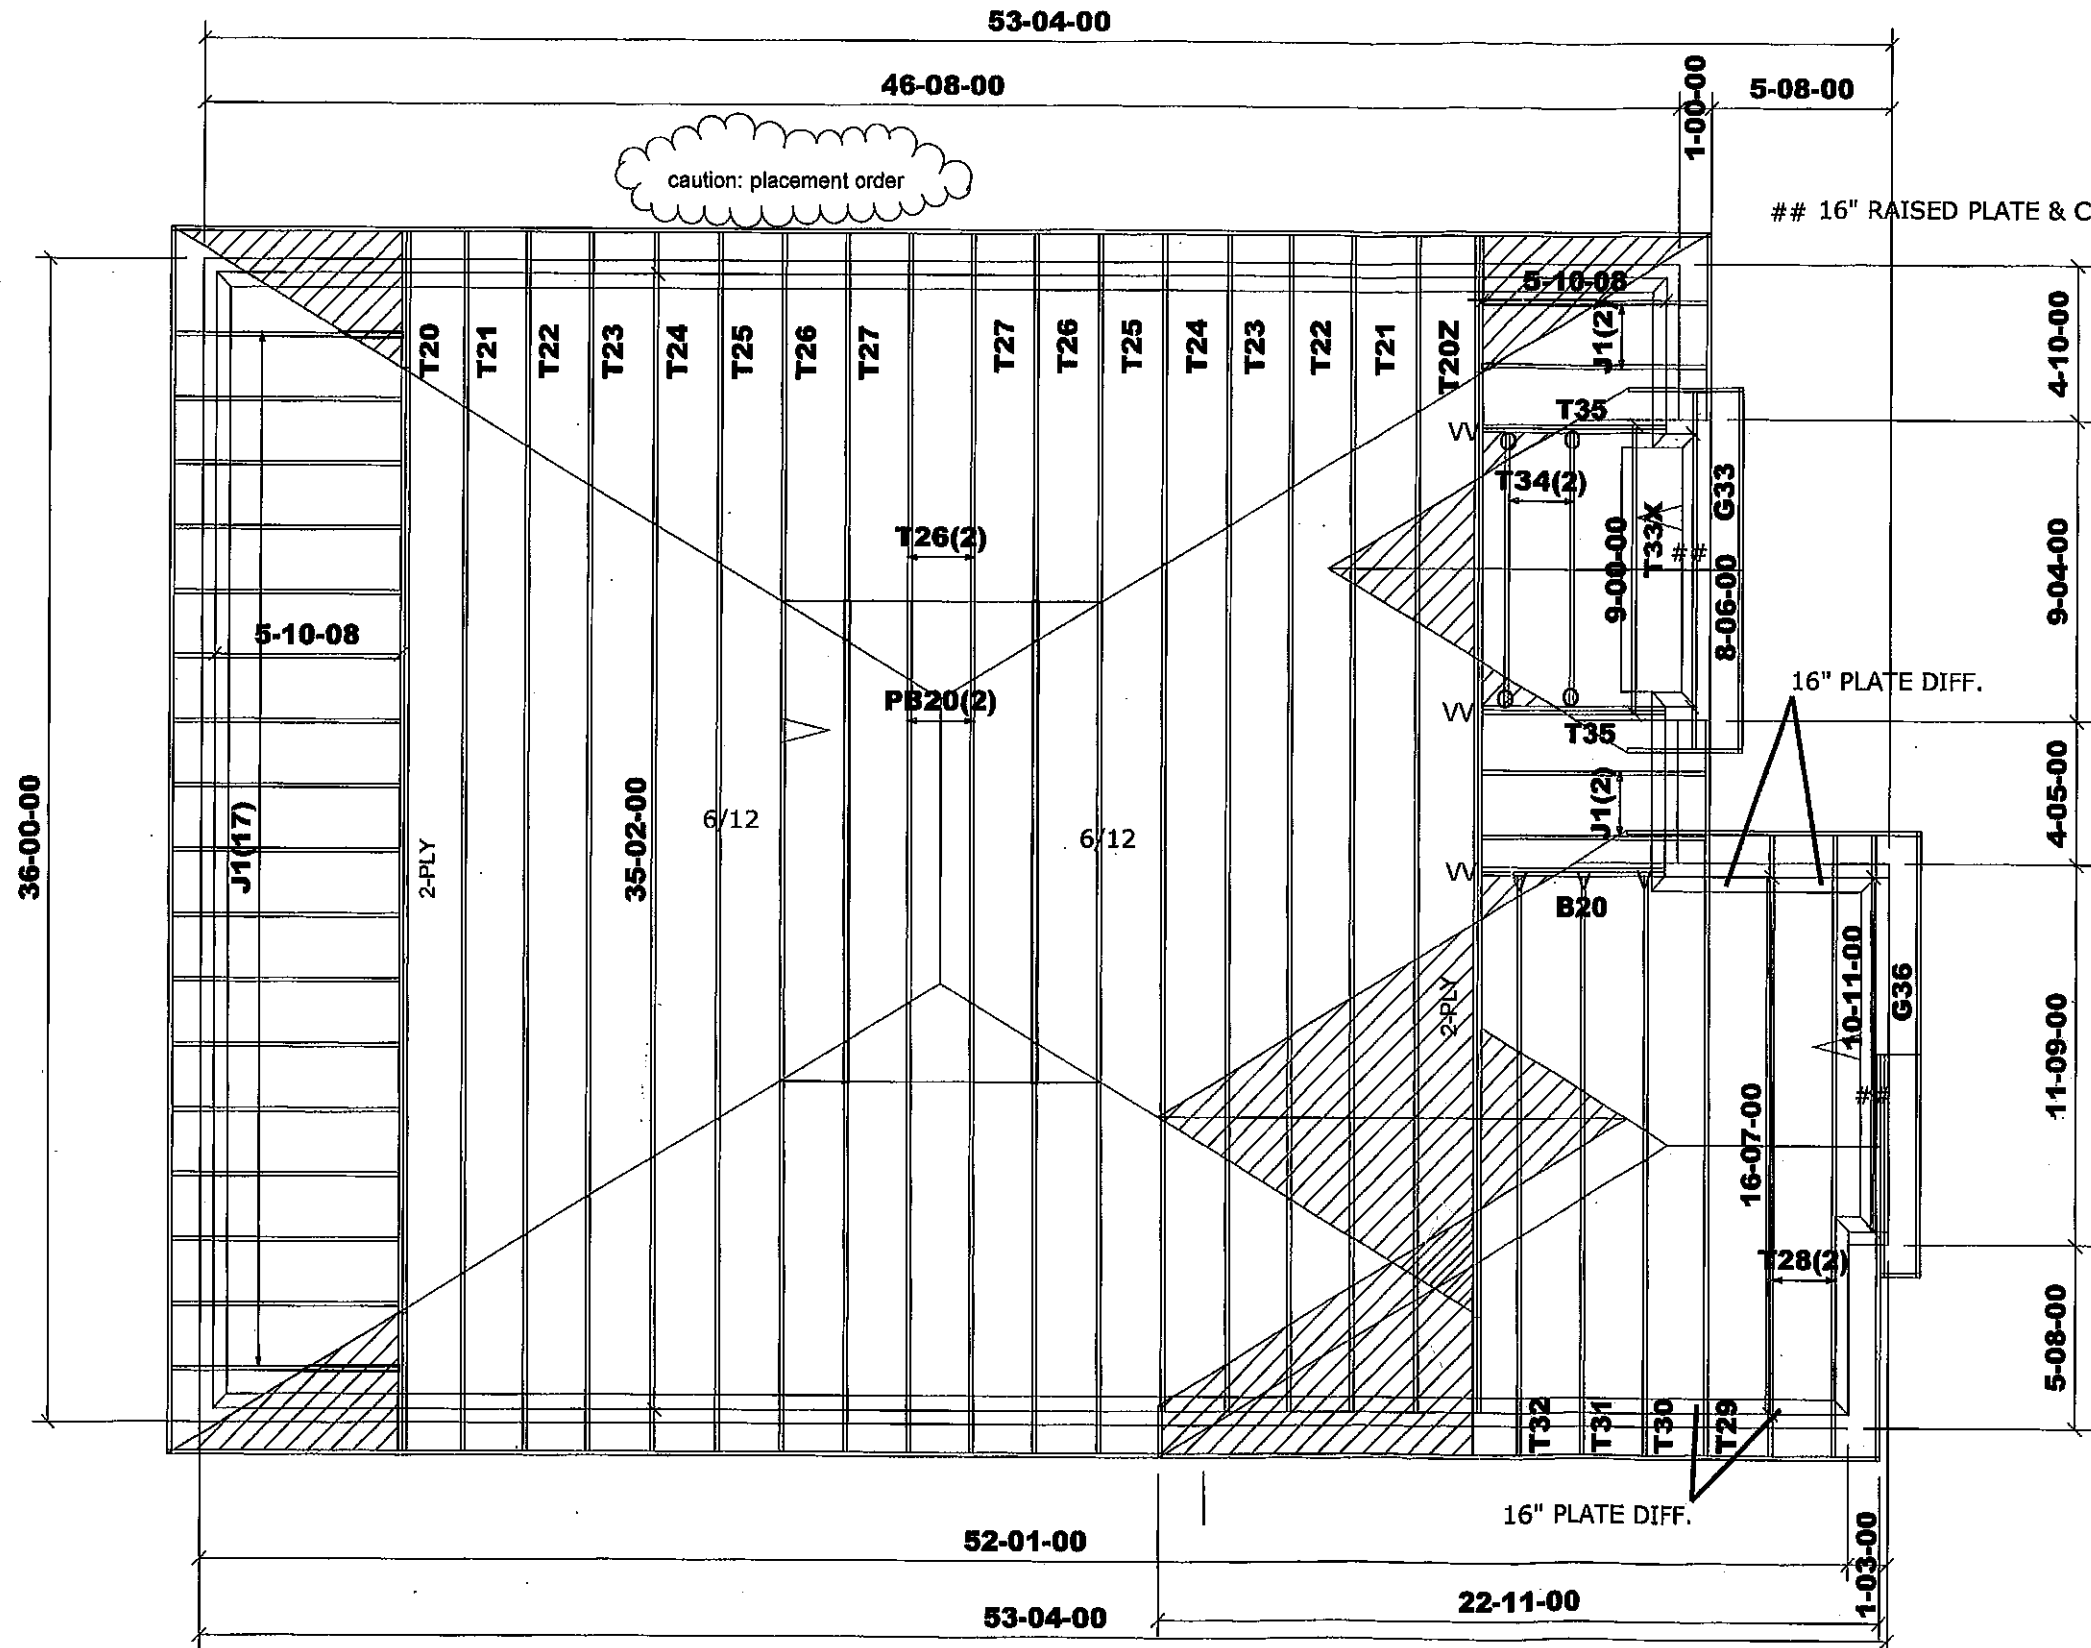

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
LUS26-2-(VV)

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by

Permit No. 21-105963
JUN 28 2021
DATE

FOR CHIEF BUILDING OFFICIAL

BEAMS:
B20 = 2 - 2x10 SPF #2

 **DENOTES:**
CONVENTIONAL
FRAMING

M13125



Job Track: 51225
Plan Log: 202401
Layout ID: 408151

Builder / Location: GREEN PARK HOMES / WATERDOWN
Project: RUSSELL GARDENS PH.3
Date: 2020-04-27 Sales: Mario DiCano Designer: JG

Model / Elevation: MOUNTAINASH 4/2-std or opt. LOT 191

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

DELIVERY SHIPLIST




Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 4
 Lot #: 191
 Elevation: 2-std or opt.

Job Track: 51225
 PlanLog: 202401
 Layout ID: 408151
 Ref #
 Page: 1 of 2
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T20 Hip Girder	10 /12	35-02-00	4-01-11	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	365.29 218.00		
	1 2-ply	T20Z Hip Girder	10 /12	35-02-00	4-01-11	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	365.29 218.00		
	2	T21 Hip	10 /12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	293.44 185.67		
	2	T22 Hip	10 /12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	296.43 188.67		
	2	T23 Hip	10 /12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	323.09 204.33		
	2	T24 Hip	10 /12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	326.19 204.67		
	2	T25 Hip	10 /12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	363.03 228.67		
	4	T26 Hip	10 /12	35-02-00	10-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	693.28 432.00		
	2	T27 Hip	10 /12	35-02-00	11-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	380.36 236.67		
	2	T28 Common	10 /12	16-07-00	8-06-10	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	163.16 102.67		
	1	T29 Common	10 /12	16-07-00	9-10-10	2 x 4	1-03-08 1-03-08	2-11-11 2-11-11	90.52 56.67		
	1	T30 Hip	10 /12	16-07-00	9-05-12	2 x 4	1-03-08 1-03-08	2-11-11 2-11-11	97.28 61.17		
	1	T31 Hip	10 /12	16-07-00	8-05-12	2 x 4	1-03-08 1-03-08	2-11-11 2-11-11	91.81 58.17		
	1	T32 Hip	10 /12	16-07-00	7-05-12	2 x 4	1-03-08 1-03-08	2-11-11 2-11-11	79.39 48.83		

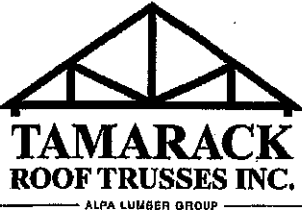 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST				
	Lumber Yard:	TAMARACK LUMBER		Job Track:	51225
	Builder:	GREEN PARK HOMES		PlanLog:	202401
	Project:	RUSSELL GARDENS PH.3		Layout ID:	408151
	Location:	WATERDOWN		Ref #	
	Model:	MOUNTAINASH 4		Page:	2 of 2
Lot #:	191		Date:	04-27-2020	
Elevation:	2-std or opt.		Designer:		
			Sales Rep:	Mario DiCano	

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T33X Common	10 /12	9-00-00	5-02-03	2 x 4		1-05-03 1-05-03	37.02 25.50		
	1	G33 GABLE	10 /12	8-06-00	5-02-03	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	41.62 27.83		
	2	T34 Common	10 /12	8-06-00	6-06-03	2 x 4		2-11-11 2-11-11	81.91 52.00		
	2 2-ply	T35 Flat Girder	0 /12	5-10-08	1-04-00	2 x 4		1-04-00 1-04-00	80.15 51.33		
	1	G36 GABLE	10 /12	10-11-00	6-02-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	53.04 35.33		
	2	PB20 Piggyback	10 /12	14-10-03	2-00-00	2 x 4			80.38 60.00		
	21	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	352.68 224.00		

TOTAL # TRUSS= 58

TOTAL BFT OF ALL TRUSSES= 2920.18

BFT.

TOTAL WEIGHT OF ALL TRSSES 4665.24 LBS


HARDWARE

QTY	TYPE	MODEL	LENGTH
3	Hardware	LJS26DS	
4	Hardware	LUS24	
3	Hardware	LUS26-2	

TOTAL NUMBER OF
ITEMS=

10

JOB NAME 408150	TRUSS NAME T1	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mike Industries, Inc. Sat Apr 25 11:02:47 2020 Page 1					
ID:7vF7aG0E03cRUj6X1SrkziWYK-VShX5DRAXNen15LAM_IsZu8zCRhpiKAOQnpVGMzNcnc					
Scale = 1:34.4					

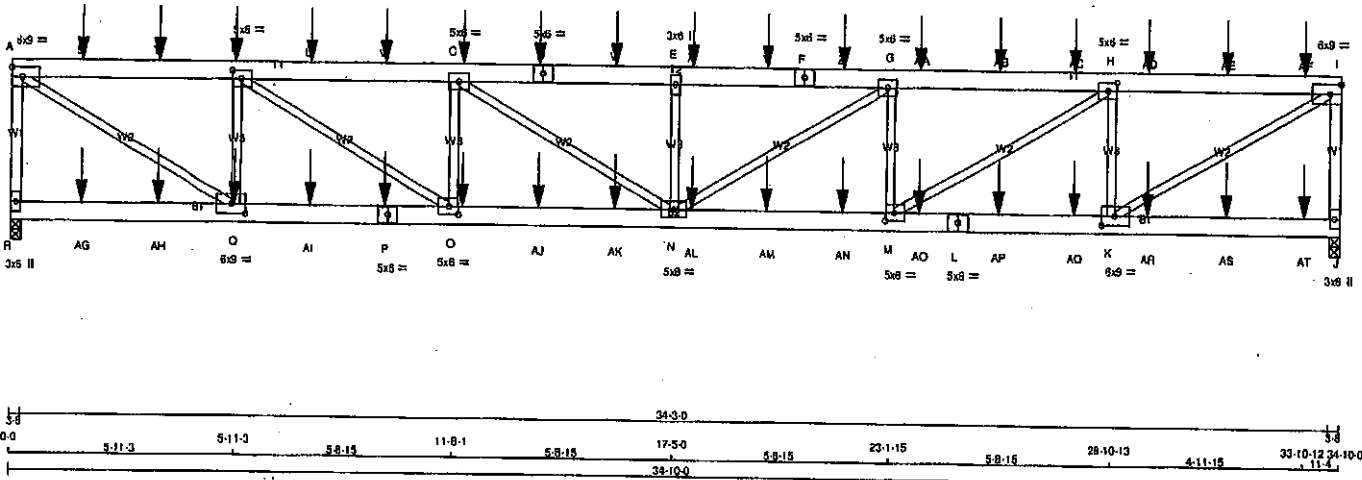

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS			
R - A	2x4	DRY	No.2
A - D	2x6	DRY	No.2
D - F	2x6	DRY	No.2
F - I	2x8	DRY	No.2
J - I	2x4	DRY	No.2
R - P	2x8	DRY	No.2
P - L	2x6	DRY	No.2
L - J	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
R - A	12	TOP
I - J	12	TOP
A - D	12	SIDE (183.1)
D - F	12	SIDE (0.0)
F - I	12	SIDE (0.0)
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
R - P	12	SIDE (183.1)
P - L	12	SIDE (183.1)
L - J	12	SIDE (0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
JT	GROSS REACTION	GROSS REACTION	BRG	BRG	
R	VERT	3052	0	3-8	3-8
J	HORZ	3118	0	3-8	3-8

UNFACTORED REACTIONS

1ST CASE	MAX./MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	2181	1401/0	0/0	0/0	0/0	781/0	0/0
J	2209	1430/0	0/0	0/0	0/0	778/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J.

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX. (PLF)	MEMB.	FORCE (LBS)
FR-TO				FR-TO	
R-A	-2974/0	0.0	0.0 0.34 (1)	K-I	0/5083
A-S	-4328/0	-91.8	-91.8 0.20 (1)	A-Q	0/5078
S-T	-4328/0	-91.8	-91.8 0.20 (1)	K-H	-2465/0
T-B	-4328/0	-91.8	-91.8 0.20 (1)	C-B	-2463/0
B-U	-6698/0	-91.8	-91.8 0.25 (1)	M-H	0/2904
U-V	-6698/0	-91.8	-91.8 0.25 (1)	B-O	0/2903
V-C	-6698/0	-91.8	-91.8 0.25 (1)	M-G	-1325/0
C-D	-7505/0	-91.8	-91.8 0.23 (1)	O-C	-1326/0
D-W	-7505/0	-91.8	-91.8 0.23 (1)	N-G	0/958
W-E	-7505/0	-91.8	-91.8 0.23 (1)	C-N	0/958
E-X	-7505/0	-91.8	-91.8 0.23 (1)	N-E	-851/0
X-Y	-7505/0	-91.8	-91.8 0.23 (1)		
Y-F	-7505/0	-91.8	-91.8 0.23 (1)		
F-Z	-7505/0	-91.8	-91.8 0.23 (1)		
Z-G	-7505/0	-91.8	-91.8 0.23 (1)		
G-AA	-6698/0	-91.8	-91.8 0.26 (1)		
AA-AB	-6698/0	-91.8	-91.8 0.26 (1)		
AB-AC	-6698/0	-91.8	-91.8 0.26 (1)		
AC-H	-6698/0	-91.8	-91.8 0.26 (1)		
H-AD	-4330/0	-91.8	-91.8 0.21 (1)		
AD-AE	-4330/0	-91.8	-91.8 0.21 (1)		
AE-AF	-4330/0	-91.8	-91.8 0.21 (1)		
AF-I	-4330/0	-91.8	-91.8 0.21 (1)		
I-J	-3028/0	0.0	0.0 0.35 (1)		

R-AG	0/0	-18.5	-18.5 0.08 (4)	10.00
AG-AH	0/0	-18.5	-18.5 0.08 (4)	10.00
AH-Q	0/0	-18.5	-18.5 0.08 (4)	10.00
Q-AI	0/4328	-18.5	-18.5 0.33 (1)	10.00
AI-P	0/4328	-18.5	-18.5 0.33 (1)	10.00
P-O	0/4328	-18.5	-18.5 0.33 (1)	10.00
O-AJ	0/6698	-18.5	-18.5 0.49 (1)	10.00
AJ-AK	0/6698	-18.5	-18.5 0.49 (1)	10.00
AK-N	0/6698	-18.5	-18.5 0.49 (1)	10.00
N-AL	0/6698	-18.5	-18.5 0.49 (1)	10.00
AL-AM	0/6698	-18.5	-18.5 0.49 (1)	10.00
AM-AN	0/6698	-18.5	-18.5 0.49 (1)	10.00
AN-M	0/6698	-18.5	-18.5 0.49 (1)	10.00
M-AO	0/4330	-18.5	-18.5 0.33 (1)	10.00
AO-L	0/4330	-18.5	-18.5 0.33 (1)	10.00
L-AP	0/4330	-18.5	-18.5 0.33 (1)	10.00
AP-AQ	0/4330	-18.5	-18.5 0.33 (1)	10.00
AQ-K	0/4330	-18.5	-18.5 0.33 (1)	10.00

TOTAL WEIGHT = 2 X 178 = 353 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
OL = 6.0 PSF
BOT CH. LL = 0.0 PSF
OL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C/C

LOADING IN PLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.20")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.38")

CSI: TC=0.35/1.00 (I-J:1), BC=0.49/1.00 (M-N:1),
WB=0.63/1.00 (K-L:1), SS=0.17/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.66 (K) (INPUT = 0.90)
JSI METAL= 0.42 (P) (INPUT = 1.00)

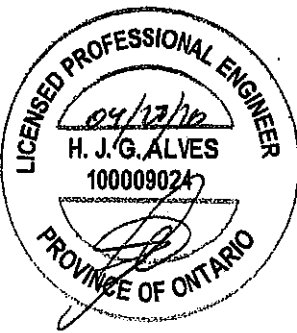

Structural component only
DWG# T-2007083

PLATES (table/s in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-I	MT20	6.0	9.0		Edge
B	TMVW-I	MT20	5.0	6.0	2.50	2.75
C	TMVW-I	MT20	5.0	6.0		
D	TS-I	MT20	5.0	6.0		
E	TMVW-w	MT20	3.0	6.0		
F	TS-I	MT20	5.0	6.0		
G	TMVW-I	MT20	5.0	6.0		
H	TMVW-I	MT20	5.0	6.0	2.50	2.75
I	TMVW-I	MT20	6.0	9.0		Edge
J	BMV1-p	MT20	3.0	6.0		
K	BMVW-I	MT20	6.0	9.0	3.00	4.25
L	BS-I	MT20	5.0	6.0		
M	BMVW-I	MT20	5.0	6.0	2.50	2.75
N	BMVW-I	MT20	5.0	6.0		
O	BMVW-I	MT20	5.0	6.0	2.50	2.75
P	BS-I	MT20	5.0	6.0		
Q	BMVW-I	MT20	6.0	9.0	3.00	4.25
R	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. MEMB. UNBRAC	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	CS1 (LC)
FR-TO		FROM TO			LENGTH FR-TO		
K-AR	0.0	-18.5	-18.5	0.08 (4)	10.00		
AR-AS	0.0	-18.5	-18.5	0.08 (4)	10.00		
AS-AT	0.0	-18.5	-18.5	0.08 (4)	10.00		
AT-J	0.0	-18.5	-18.5	0.08 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
B	5-10-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
C	11-10-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
D	13-10-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
O	11-10-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
P	9-10-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Q	5-10-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
S	1-10-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
T	3-10-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	7-10-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	9-10-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	15-10-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	17-10-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	19-10-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	21-10-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	23-10-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	25-10-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	27-10-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	29-10-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	31-10-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	33-10-12	-113	-113	---	FRONT	VERT	TOTAL	---	C1
AG	1-10-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	3-10-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	7-10-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	13-10-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	15-10-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AL	17-10-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AM	19-10-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AN	21-10-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AO	23-10-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AP	25-10-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AQ	27-10-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AR	29-10-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AS	31-10-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AT	33-10-12	-27	-27	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408150	T1Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:02:49 2020 Page 1
ID:17VF?AG0E03cRUj6X1jSkzWYK-zfWzZSohMefFwNwhG566h7Ury008GacTEqvOzNCnb

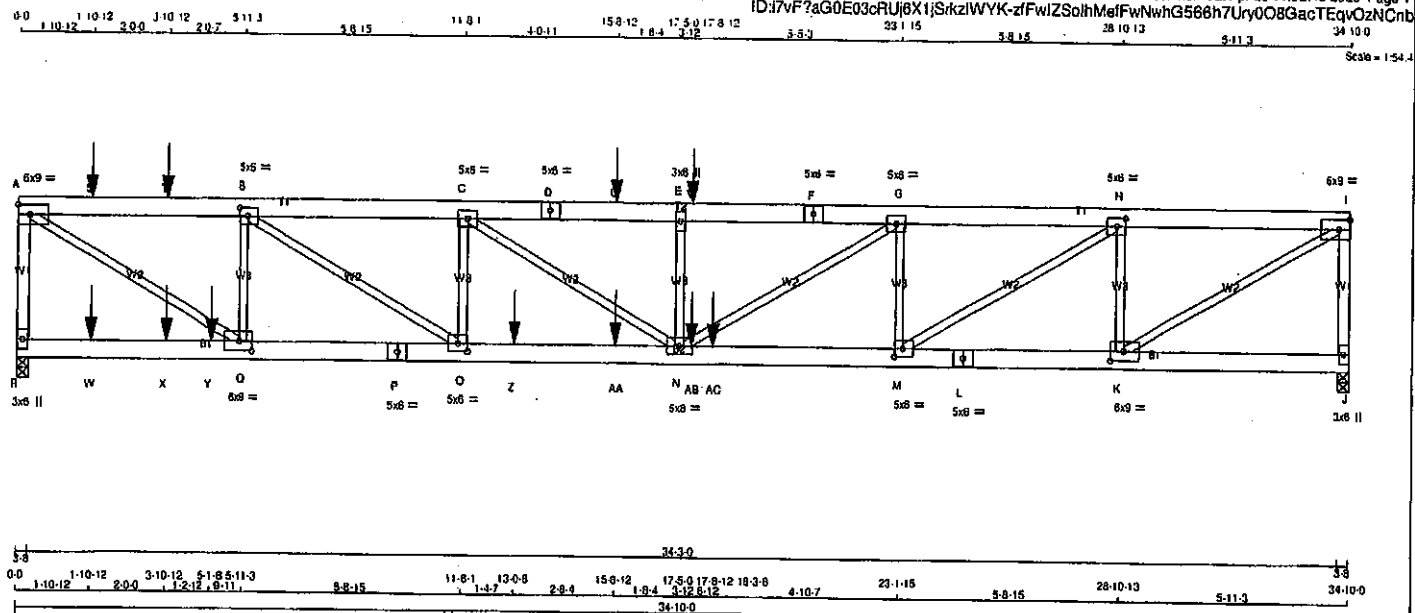

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
R - A	2x4	DRY	No.2
A - D	2x6	DRY	No.2
D - F	2x6	DRY	No.2
F - I	2x6	DRY	No.2
J - L	2x4	DRY	No.2
R - P	2x6	DRY	No.2
P - L	2x6	DRY	No.2
L - J	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
R - A	12	TOP
F - J	12	TOP
A - D	12	SIDE(0.0)
D - F	12	SIDE(183.1)
F - I	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
R - P	12	SIDE(0.0)
P - L	12	SIDE(183.1)
L - J	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED	MAXIMUM FACTORED	INPUT	REQD			
	GROSS REACTION	GROSS REACTION	BRG	BRG			
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
R	4002	0	4002	0	0	3-8	3-8
J	3132	0	3132	0	0	3-8	3-8

UNFACTORED REACTIONS							
	1ST LOASE	MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	2824	1886 / 0	0 / 0	0 / 0	0 / 0	938 / 0	0 / 0
J	2212	1470 / 0	0 / 0	0 / 0	0 / 0	742 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.64 FT.
MAX. UNSRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO				FR-TO			
R-A	-3851 / 0	0.0	0.0 0.44 (1)	0.01	K-I	0 / 5428	0.87 (1)
A-S	-5722 / 0	-91.8	-91.8 0.25 (1)	4.72	A-Q	0 / 8717	0.83 (1)
S-T	-5722 / 0	-91.8	-91.8 0.25 (1)	4.72	K-H	-2763 / 0	0.33 (1)
T-B	-5722 / 0	-91.8	-91.8 0.25 (1)	4.72	Q-B	-2710 / 0	0.32 (1)
B-C	-8846 / 0	-91.8	-91.8 0.27 (1)	3.93	M-H	0 / 4038	0.50 (1)
C-D	-10219 / 0	-91.8	-91.8 0.34 (1)	3.84	B-O	0 / 3700	0.46 (1)
D-U	-10219 / 0	-91.8	-91.8 0.34 (1)	3.84	M-G	-1901 / 0	0.23 (1)
U-E	-10219 / 0	-91.8	-91.8 0.34 (1)	3.84	O-C	-1400 / 0	0.17 (1)
E-V	-10219 / 0	-91.8	-91.8 0.31 (1)	3.87	N-G	0 / 2591	0.32 (1)
V-F	-10219 / 0	-91.8	-91.8 0.31 (1)	3.87	C-N	0 - 1626	0.20 (1)
F-G	-10219 / 0	-91.8	-91.8 0.31 (1)	3.87	N-E	-710 / 0	0.08 (1)
G-H	-3031 / 0	-91.8	-91.8 0.23 (1)	4.14			
H-I	-4622 / 0	-91.8	-91.8 0.15 (1)	5.25			
I-J	-3071 / 0	0.0	0.0 0.35 (1)	6.60			
R-W	0 / 0	-18.5	-18.5 0.15 (1)	10.00			
W-X	0 / 0	-18.5	-18.5 0.15 (1)	10.00			
X-Y	0 / 0	-18.5	-18.5 0.15 (1)	10.00			
Y-Q	0 / 0	-18.5	-18.5 0.15 (1)	10.00			
Q-P	0 / 5722	-18.5	-18.5 0.44 (1)	10.00			
P-O	0 / 5722	-18.5	-18.5 0.44 (1)	10.00			
O-Z	0 / 8846	-18.5	-18.5 0.81 (1)	10.00			
Z-AA	0 / 8846	-18.5	-18.5 0.81 (1)	10.00			
AA-N	0 / 8846	-18.5	-18.5 0.81 (1)	10.00			
N-AB	0 / 8031	-18.5	-18.5 0.74 (1)	10.00			
AB-AC	0 / 8031	-18.5	-18.5 0.74 (1)	10.00			
AC-M	0 / 8031	-18.5	-18.5 0.74 (1)	10.00			
M-L	0 / 4622	-18.5	-18.5 0.33 (1)	10.00			
L-K	0 - 4622	-18.5	-18.5 0.33 (1)	10.00			
K-J	0 / 0	-18.5	-18.5 0.04 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL
S	1-10-12	-110	-110	---	BACK	VERT	TOTAL
T	3-10-12	-110	-110	---	BACK	VERT	TOTAL
U	15-8-12	-110	-110	---	BACK	VERT	TOTAL
V	17-8-12	-110	-110	---	BACK	VERT	TOTAL
W	1-10-12	-26	-26	---	BACK	VERT	TOTAL
X	3-10-12	-26	-26	---	BACK	VERT	TOTAL
Y	5-1-8	-727	-727	---	BACK	VERT	TOTAL
Z	13-0-8	-727	-727	---	BACK	VERT	TOTAL
AA	15-8-12	-26	-26	---	BACK	VERT	TOTAL
AB	17-8-12	-26	-26	---	BACK	VERT	TOTAL

TOTAL WEIGHT = 2 X 176 = 353 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC0 2010, NBC0 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL (LL) = L/360 (1.18")
CALCULATED VERT. DEFL (LL) = L/989 (0.28")
ALLOWABLE DEFL (TL) = L/360 (1.18")
CALCULATED VERT. DEFL (TL) = L/828 (0.50")

CSI: TC=0.44/1.00 (A-R:1), BC=0.81/1.00 (N-O:1), WB=0.83/1.00 (A-Q:1), SS=0.41/1.00 (H-N:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1887 768 1887 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.88 (M) (INPUT = 0.90)
JSI METAL = 0.50 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007064 1/2

CONTINUED ON PAGE 2

JOB NAME 408150	TRUSS NAME T1Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 11:02:49 2020 Page 2
ID: i7vF? aG0E03cRU6X1S8ziWYK-SrplVvTQ3 UVQPVZTPnKeJDIEFIF7bWigZ NRzNCna

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	6.0	9.0		Edge
B	TMWW-t	MT20	5.0	8.0	2.50	2.75
C	TMWW-t	MT20	5.0	6.0		
D	TS-t	MT20	5.0	6.0		
E	TMW+w	MT20	3.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMWW-t	MT20	5.0	6.0		
H	TMWW-t	MT20	5.0	6.0	2.50	2.75
I	TMVW-t	MT20	6.0	9.0		Edge
J	BMV1+p	MT20	3.0	6.0		
K	BMWW-t	MT20	6.0	9.0	3.00	4.25
L	BS-t	MT20	5.0	8.0		
M	BMWW-t	MT20	5.0	8.0	2.50	2.75
N	BMWWWW-t	MT20	5.0	8.0		
O	BMWWWW-t	MT20	5.0	8.0	2.50	2.75
P	BS-t	MT20	5.0	8.0		
Q	BMWW-t	MT20	6.0	9.0	3.00	4.25
R	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
AC	18-3-8	-1293	-1293		BACK	VERT	TOTAL		CI

CONNECTION REQUIREMENTS


1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007064 72

JOB NAME 408150	TRUSS NAME T2	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:02:50 2020 Page 1
ID:7v7aG0E03cRUj6X1iSrkzWYK-w1MqFT2qldMuZ416IZBXmNxeiPs5W3npxzHZNcZ

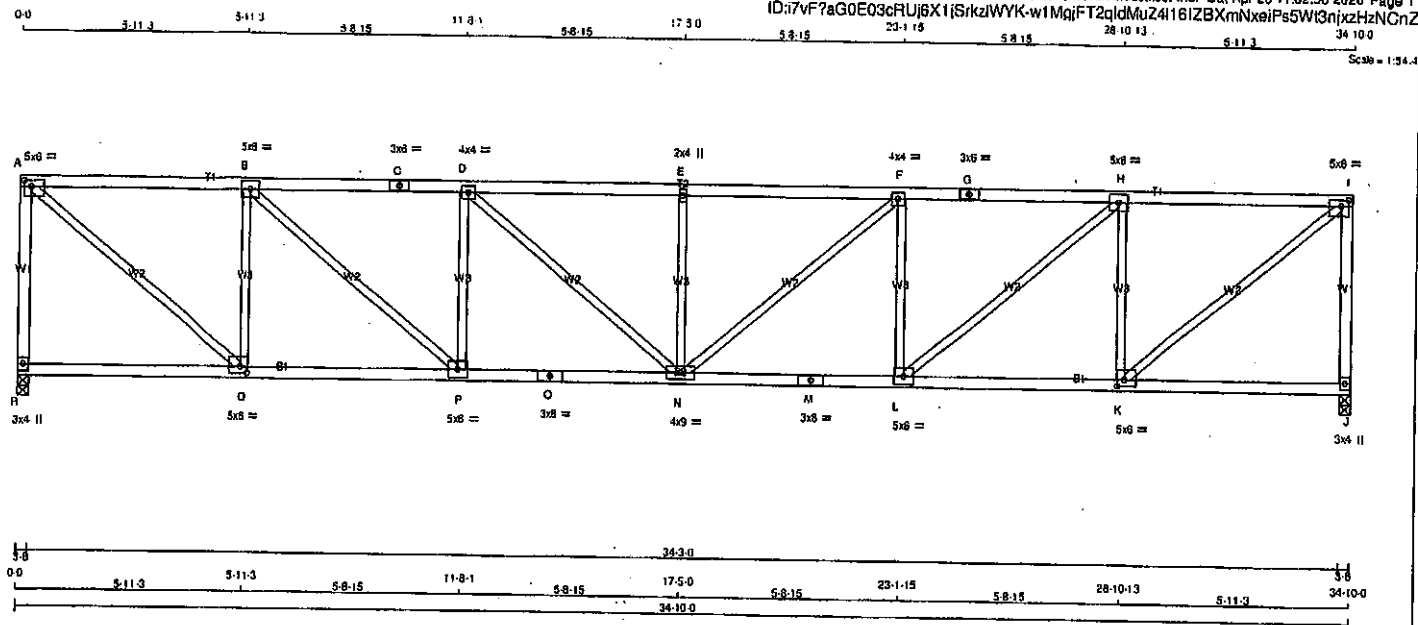

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
R - A	2x4	DRY	No.2
C - C	2x4	DRY	No.2
C - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
J - I	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW-1	MT20	5.0	8.0	2.00 2.25
B	TMVW-1	MT20	5.0	6.0	
C	TS-1	MT20	3.0	6.0	
D	TMVW-1	MT20	4.0	4.0	
E	TMVW-1	MT20	2.0	4.0	
F	TMVW-1	MT20	4.0	4.0	
G	TS-1	MT20	3.0	6.0	
H	TMVW-1	MT20	5.0	6.0	
I	TMVW-1	MT20	5.0	8.0	2.00 2.25
J	BMV1-p	MT20	3.0	4.0	
K	BMVW-1	MT20	5.0	6.0	2.00 2.25
L	BMVW-1	MT20	5.0	6.0	
M	SS-1	MT20	3.0	8.0	
N	BMVW-1	MT20	4.0	9.0	
O	SS-1	MT20	3.0	8.0	
P	BMVW-1	MT20	5.0	6.0	
Q	BMVW-1	MT20	5.0	6.0	2.00 2.25
R	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
R	1920	0	1920	0	3-8
J	1920	0	1920	0	3-8

UNFACTORED REACTIONS

JT	1ST LOOSE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1358	891 / 0	0 / 0	0 / 0	0 / 0	0 / 0	467 / 0	0 / 0
J	1358	891 / 0	0 / 0	0 / 0	0 / 0	0 / 0	467 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.23 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORZ. LOAD (LBS)
R-A	-1875 / 0	0.0	0.0
A-B	-2042 / 0	-91.8	-91.8
B-C	-3149 / 0	-91.8	-91.8
C-D	-3149 / 0	-91.8	-91.8
D-E	-3533 / 0	-91.8	-91.8
E-F	-3533 / 0	-91.8	-91.8
F-G	-3149 / 0	-91.8	-91.8
G-H	-3149 / 0	-91.8	-91.8
H-I	-2042 / 0	-91.8	-91.8
I-J	-1875 / 0	0.0	0.0
R-Q	0 / 0	-18.5	-18.5
Q-P	0 / 2042	-18.5	-18.5
P-O	0 / 3149	-18.5	-18.5
O-N	0 / 3149	-18.5	-18.5
N-M	0 / 3149	-18.5	-18.5
M-L	0 / 3149	-18.5	-18.5
L-K	0 / 2042	-18.5	-18.5
K-J	0 / 0	-18.5	-18.5

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN PLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (1.16")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.23")
ALLOWABLE DEFL. (TL) = $L/360$ (1.16")
CALCULATED VERT. DEFL. (TL) = $L/998$ (0.42")

CSI: TC=0.83/1.00 (A-R:1), BC=0.58/1.00 (N-P:1), WB=0.59/1.00 (I-K:1), SS=0.25/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.89 (A) (INPUT = 0.90)
JSI METAL = 0.99 (M) (INPUT = 1.00)

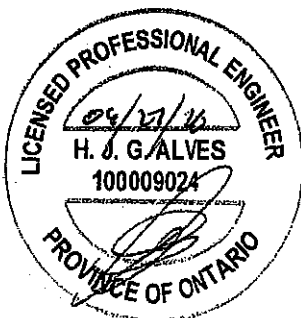

Structural component only
DWG# T-2007065

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408150	T3	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 3 Oct 29 2019 Mitex Industries, Inc. Sat Apr 25 11:02:51 2020 Page 1
 ID:7vF7aG0E03cRUj6X1jSrkzIWKY-OEW2wbUhbclDWIxbqpkJkK233bSy0lRTUvIzNCnY
 Scale = 1/4" = 1'-0"

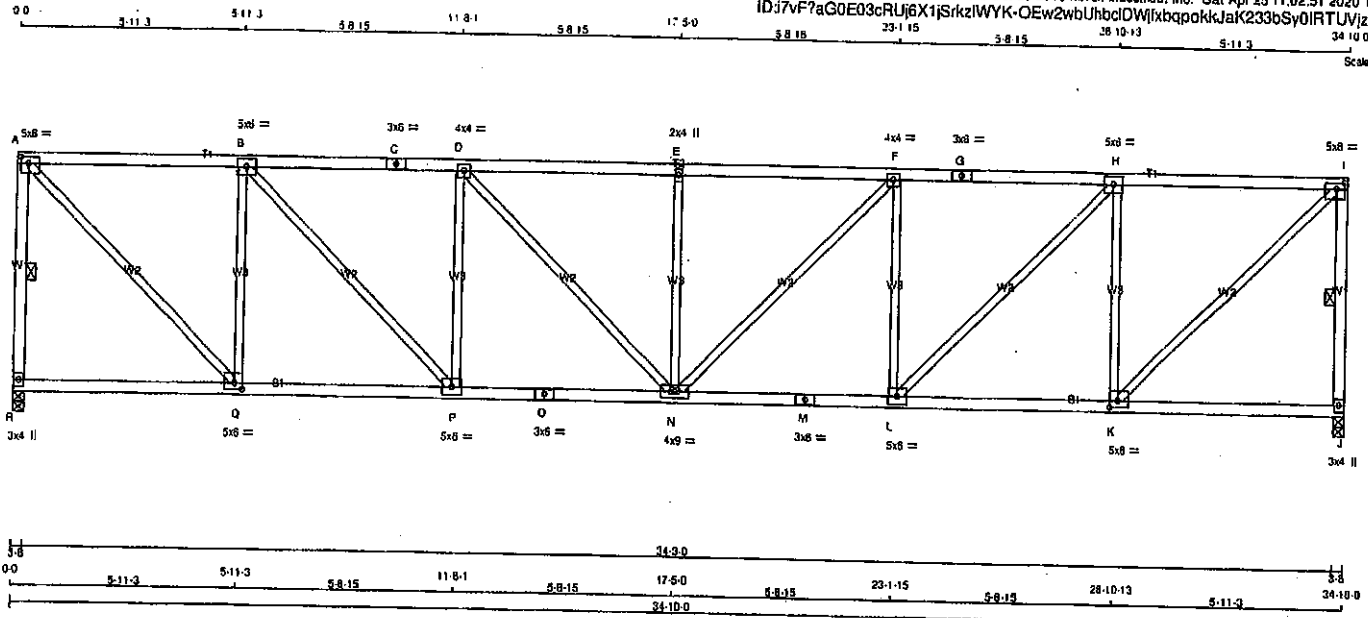

CHORDS	SIZE	LUMBER	DESCR.
R - A	2x4 DRY	No.2	SPF
A - C	2x4 DRY	No.2	SPF
C - G	2x4 DRY	No.2	SPF
G - I	2x4 DRY	No.2	SPF
J - I	2x4 DRY	No.2	SPF
R - O	2x4 DRY	No.2	SPF
O - M	2x4 DRY	No.2	SPF
M - J	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
DRY: SEASONED LUMBER.			

PLATES (table in inches)	W	LEN	Y	X
JT TYPE	MT20	5.0	6.0	2.00 2.50
A - TMWV-1	MT20	5.0	6.0	
B - TMWV-1	MT20	5.0	6.0	
C - TS-1	MT20	3.0	6.0	
D - TMWV-1	MT20	4.0	4.0	
E - TMWV-1	MT20	2.0	4.0	
F - TMWV-1	MT20	4.0	4.0	
G - TS-1	MT20	3.0	6.0	
H - TMWV-1	MT20	5.0	6.0	
I - TMWV-1	MT20	5.0	6.0	2.00 2.50
J - BMV1-p	MT20	3.0	4.0	
K - BMWV-1	MT20	5.0	6.0	2.00 2.50
L - BMWV-1	MT20	5.0	6.0	
M - BS-1	MT20	3.0	6.0	
N - BMWV-1	MT20	4.0	6.0	
O - BS-1	MT20	3.0	6.0	
P - BMWV-1	MT20	5.0	6.0	
Q - BMWV-1	MT20	5.0	6.0	2.00 2.50
R - BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	1920	0	0	3-8
R 1920	0	1920	0	3-8
J 1920	0	1920	0	3-8

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	SNOW	LIVE
R 1358	891 / 0	0 / 0
J 1358	891 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.59 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-R, I-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
 TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	UNBRAC LENGTH	WEBS	MAX. FACTORED MEMB. FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO			FR-TO		
R-A	-1875 / 0	0.0	0.0	0.33 (1)	4.90	K-I	0 / 2368
A-B	-1891 / 0	-91.8	-91.8	0.55 (1)	4.46	A-Q	0 / 2368
B-C	-2808 / 0	-91.8	-91.8	0.86 (1)	3.83	K-H	-1536 / 0
C-D	-2808 / 0	-91.8	-91.8	0.86 (1)	3.83	O-B	-1536 / 0
D-E	-2927 / 0	-91.8	-91.8	0.58 (1)	3.59	L-H	0 / 1304
E-F	-2927 / 0	-91.8	-91.8	0.58 (1)	3.59	B-P	0 / 1304
F-G	-2808 / 0	-91.8	-91.8	0.68 (1)	3.53	L-F	-826 / 0
G-H	-2808 / 0	-91.8	-91.8	0.68 (1)	3.53	P-D	-826 / 0
H-I	-1891 / 0	-91.8	-91.8	0.55 (1)	4.46	N-F	0 / 453
J-I	-1875 / 0	0.0	0.0	0.33 (1)	4.90	D-N	0 / 453
						N-E	-537 / 0
R-Q	0 / 0	-18.5	-18.5	0.15 (4)	10.00		
Q-P	0 / 1691	-18.5	-18.5	0.35 (1)	10.00		
P-O	0 / 2808	-18.5	-18.5	0.47 (1)	10.00		
O-N	0 / 2808	-18.5	-18.5	0.47 (1)	10.00		
N-M	0 / 2808	-18.5	-18.5	0.47 (1)	10.00		
M-L	0 / 2808	-18.5	-18.5	0.47 (1)	10.00		
L-K	0 / 1691	-18.5	-18.5	0.35 (1)	10.00		
K-J	0 / 0	-18.5	-18.5	0.15 (4)	10.00		

TOTAL WEIGHT = 2 X 153 = 305 lb

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2010, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16')
 CALCULATED VERT. DEFL.(LL) = L/999 (0.18')
 ALLOWABLE DEFL.(TL) = L/360 (1.16')
 CALCULATED VERT. DEFL.(TL) = L/999 (0.33')

CSI: TC=0.68/1.00 (F-H:1), BC=0.47/1.00 (N-P:1), WB=0.90/1.00 (H-K:1), SS=0.25/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1887
	618	354	1887
	618	354	1887
	618	354	1887

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.88 (I) (INPUT = 0.90)
 JSI METAL= 0.83 (M) (INPUT = 1.00)

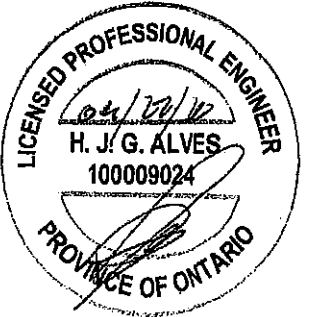


Structural component only
 DWG# T-2007066

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408150	T4	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 11:02:52 2020 Page 1

ID:7vF7aG0E03cRUj6X1jSkziWYK-sQUQ8wVJMv47IE88XL1GyrhNSOJK7q9W4C12AzNCnX

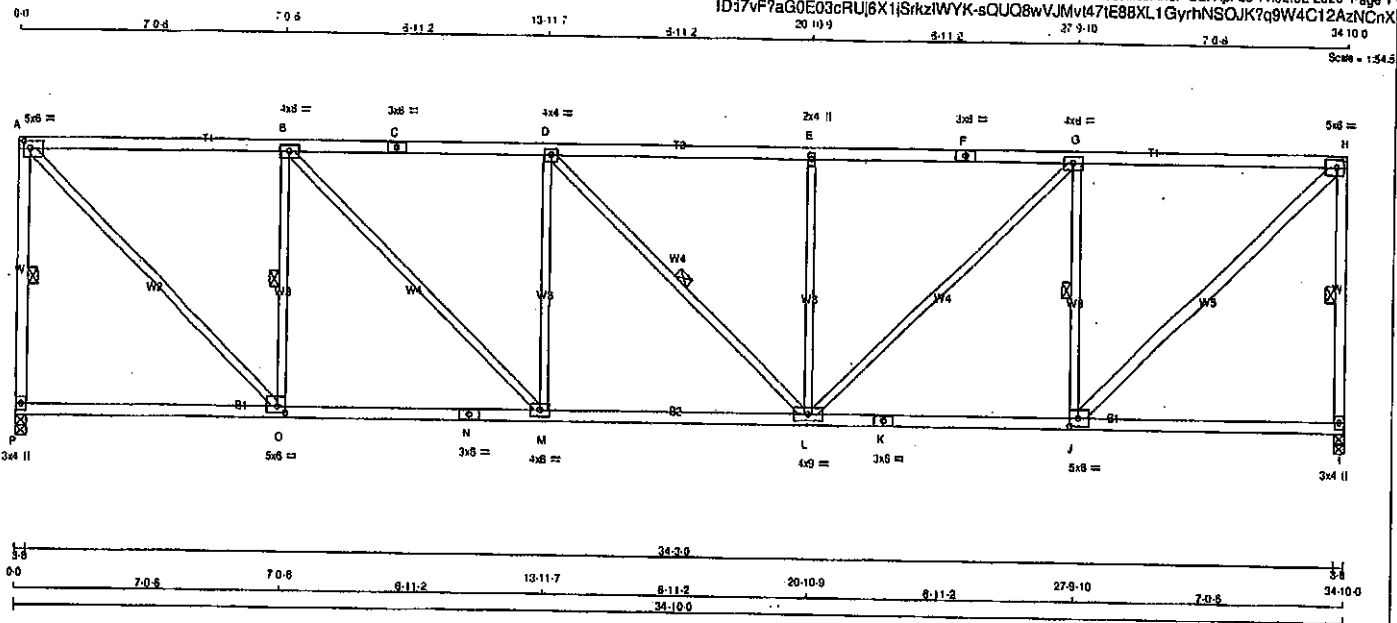

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
P - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
I - H	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
J - H	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y
A	TMWV-1	MT20	5.0	6.0	2.25
B	TMWV-1	MT20	4.0	6.0	
C	TS-1	MT20	3.0	6.0	
D	TMWV-1	MT20	4.0	4.0	
E	TMWV-1	MT20	2.0	4.0	
F	TS-1	MT20	3.0	6.0	
G	TMWV-1	MT20	4.0	6.0	
H	TMWV-1	MT20	5.0	6.0	2.50
I	BMV1-p	MT20	3.0	4.0	
J	BMWV-1	MT20	5.0	6.0	2.50
K	BS-1	MT20	3.0	6.0	
L	BMWVW-1	MT20	4.0	6.0	
M	BMWVW-1	MT20	4.0	6.0	
N	BS-1	MT20	3.0	6.0	
O	BMWV-1	MT20	5.0	6.0	2.00
P	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	FACTORED	MAXIMUM FACTORED	INPUT	REQD			
	GROSS REACTION	GROSS REACTION	BRG	BRG			
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
P	1920	0	1920	0	0	3-8	3-8
I	1920	0	1920	0	0	3-8	3-8
UNFACTORED REACTIONS							
JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
P	1358	891/0	0/0	0/0	0/0	467/0	0/0
I	1358	891/0	0/0	0/0	0/0	467/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.31 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-P, H-I, B-Q, D-L, G-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING			
TOTAL LOAD CASES: (4)			
CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)
FR-TO			
P-A	-1888/0	0.0	0.0 0.43 (1)
A-B	-1692/0	-91.8	-91.8 0.82 (1)
B-C	-2418/0	-91.8	-91.8 0.95 (1)
C-D	-2416/0	-91.8	-91.8 0.95 (1)
D-E	-2415/0	-91.8	-91.8 0.74 (1)
E-F	-2415/0	-91.8	-91.8 0.98 (1)
F-G	-2415/0	-91.8	-91.8 0.86 (1)
G-H	-1693/0	-91.8	-91.8 0.82 (1)
H-I	-1888/0	0.0	0.0 0.43 (1)
P-O	0/0	-18.5	-18.5 0.22 (4)
O-N	0/1862	-18.5	-18.5 0.39 (1)
N-M	0/1862	-18.5	-18.5 0.39 (1)
M-L	0/2418	-18.5	-18.5 0.47 (1)
L-K	0/1883	-18.5	-18.5 0.39 (1)
K-J	0/1883	-18.5	-18.5 0.39 (1)
J-I	0/0	-18.5	-18.5 0.22 (4)
WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. FACTORED FORCE (LBS)
FR-TO			
A-O	0/2315	4.91	0/2315
O-B	-1468/0	4.04	0/2315
B-M	0/1058	3.33	0/1058
M-D	-617/0	3.33	0/1058
D-L	-2/0	3.73	0/1058
L-E	-618/0	3.31	0/1058
E-G	0/1054	3.31	0/1054
G-J	-1465/0	4.02	0/1054
J-H	0/2316	4.91	0/2316

TOTAL WEIGHT = 2 X 157 = 313 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2015, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 089-09, CSA 089-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.15")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.20")

CSI: TC=0.96/1.00 (E-G:1), BC=0.47/1.00 (L-M:1), WB=0.54/1.00 (D-M:1), SS=0.39/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1867 788 1887 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (A) (INPUT = 0.90)

JSI METAL = 0.53 (K) (INPUT = 1.00)




Structural component only
DWG# T-2007067

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408150	T5	10	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:02:53 2020 Page 1
ID:7vF7aG0E03cRUj6X1jSrkzIWK-Kc2pLGWx7D7x10pKiFsGp90s5lI30NjkybacZNCrW
34-63 34-10-0
3.2
Scale = 1/4" = 1'-0"

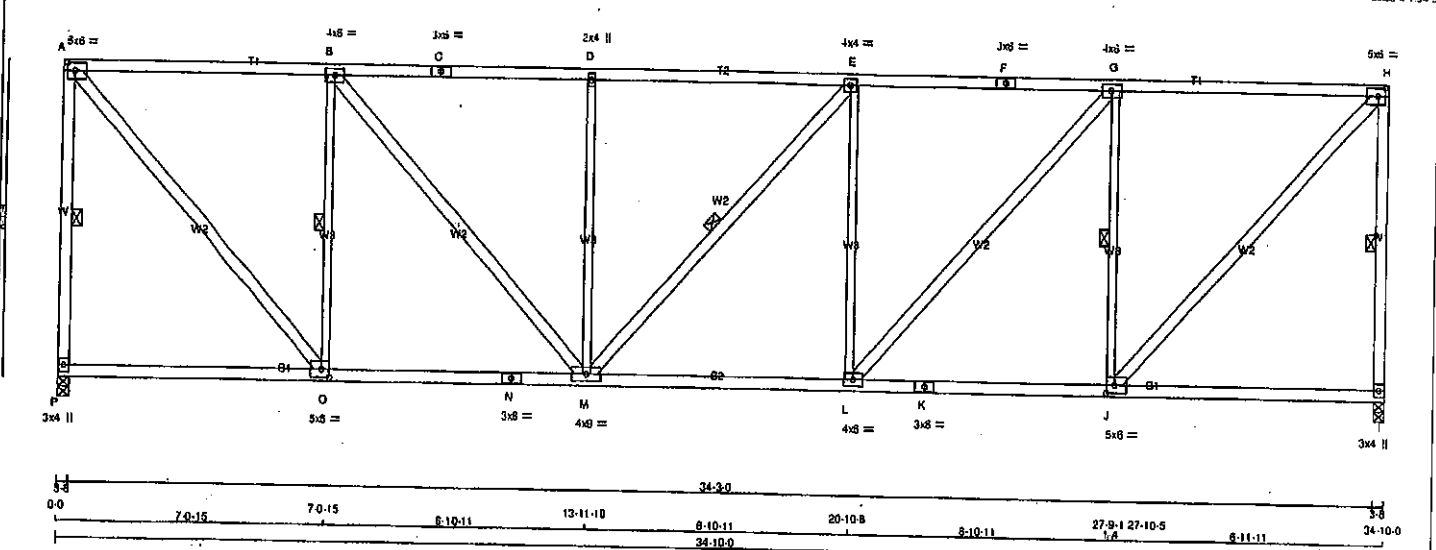

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
P - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
I - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
ALL WEBS EXCEPT	2x4	DRY	No.2
J - G	2x3	DRY	No.2
O - B	2x3	DRY	No.2
L - E	2x3	DRY	No.2
M - D	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMWV-I	MT20	5.0	6.0	2.50 2.50
B	TMWV-I	MT20	4.0	6.0	
C	TS-I	MT20	3.0	6.0	
D	TMWV-I	MT20	2.0	4.0	
E	TMWV-I	MT20	4.0	4.0	
F	TS-I	MT20	3.0	6.0	
G	TMWV-I	MT20	4.0	6.0	
H	TMWV-I	MT20	5.0	6.0	2.50 2.50
I	BMV-I	MT20	3.0	4.0	
J	BMWV-I	MT20	5.0	6.0	2.50 2.50
K	BS-I	MT20	3.0	6.0	
L	BMWV-I	MT20	4.0	6.0	
M	BMWV-I	MT20	4.0	9.0	
N	BS-I	MT20	3.0	6.0	
O	BMWV-I	MT20	5.0	6.0	2.50 2.50
P	BMV-I	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED	MAXIMUM FACTORED	INPUT	REQD	
	GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
P	1920	0	1920	0	0
I	1920	0	1920	0	0

UNFACTORED REACTIONS					
1ST CASE	MAX	MIN	COMPONENT	REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM	LIVE
P	1358	691 / 0	0 / 0	0 / 0	0 / 0
I	1358	691 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.56 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-P, H-I, G-J, B-O, E-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
P-A	-1688 / 0	0.0	0.0 0.55 (1)	J-H	0 / 2171	0.35 (1)	
A-B	-1458 / 0	-91.8	-91.8 0.90 (1)	A-O	0 / 2171	0.35 (1)	
B-C	-2108 / 0	-91.8	-91.8 0.90 (1)	J-G	-1483 / 0	0.81 (1)	
C-D	-2108 / 0	-91.8	-91.8 0.90 (1)	O-B	-1482 / 0	0.81 (1)	
D-E	-2108 / 0	-91.8	-91.8 0.68 (1)	L-G	0 / 982	0.16 (1)	
E-F	-2108 / 0	-91.8	-91.8 0.90 (1)	B-M	0 / 980	0.16 (1)	
F-G	-2108 / 0	-91.8	-91.8 0.90 (1)	L-E	-613 / 0	0.78 (1)	
G-H	-1458 / 0	-91.8	-91.8 0.79 (1)	M-D	-612 / 0	0.77 (1)	
H-I	-1688 / 0	0.0	0.0 0.55 (1)	M-E	-2 / 0	0.00 (1)	

P-O	0 / 0	-18.5	-18.5 0.22 (4)	10.00
O-N	0 / 1458	-18.5	-18.5 0.38 (1)	10.00
N-M	0 / 1458	-18.5	-18.5 0.38 (1)	10.00
M-L	0 / 2108	-18.5	-18.5 0.42 (1)	10.00
L-K	0 / 1458	-18.5	-18.5 0.38 (1)	10.00
K-J	0 / 1458	-18.5	-18.5 0.38 (1)	10.00
J-I	0 / 0	-18.5	-18.5 0.22 (4)	10.00

TOTAL WEIGHT = 10 X 178 = 1785 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.90/1.00 (B-D:1), BC=0.42/1.00 (L-M:1), WB=0.78/1.00 (E-L:1), SL=0.31/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (A) (INPUT = 0.90)
JSI METAL = 0.47 (N) (INPUT = 1.00)



Structural component only
DWG# T-2007068

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408150	T6	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 MTek Industries, Inc. Sat Apr 25 11:02:54 2020 Page 1					
ID:7vF?aG0E03cRU8X1jSkziWYK-opcBZcXZuX7oNAOWGyNVLNxAAG1Foy0S_0h862zNCNv					
Scale = 1:25.1					

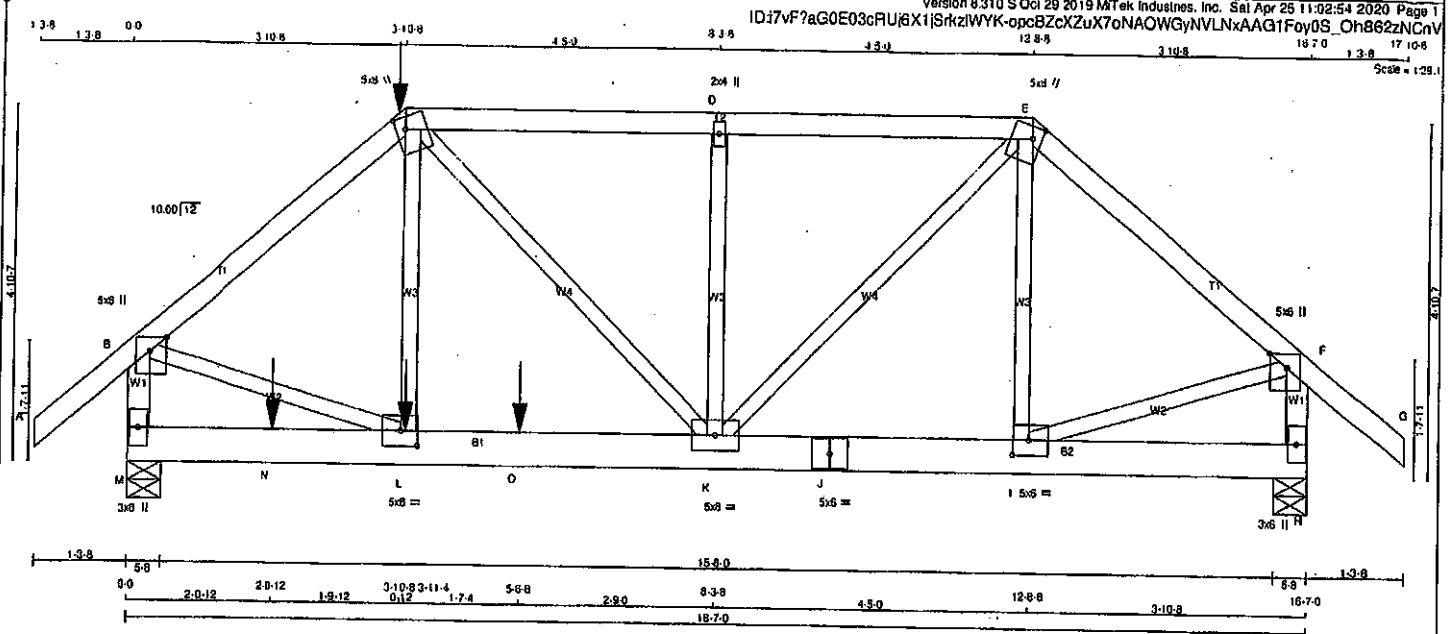

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - E	2x4	DRY	No.2	SPF		
E - G	2x4	DRY	No.2	SPF		
M - B	2x4	DRY	No.2	SPF		
H - F	2x4	DRY	No.2	SPF		
M - J	2x4	DRY	No.2	SPF		
J - H	2x4	DRY	No.2	SPF		
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF		
DRY: SEASONED LUMBER.						

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	Edge	2.75
G	TTWW+m	MT20	5.0	8.0	2.00	1.50
D	TMVW+m	MT20	2.0	4.0		
E	TTWW+m	MT20	5.0	8.0	2.00	1.50
F	TMVW+p	MT20	5.0	6.0	Edge	2.75
H	BMVW+p	MT20	3.0	6.0		
I	BMVW+p	MT20	5.0	6.0	2.50	2.75
J	BS-t	MT20	5.0	6.0		
K	BMVWW-t	MT20	5.0	8.0		
L	BMVWW-t	MT20	5.0	8.0	2.50	2.75
M	BMVW+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REORD BRG
JT	VERT	DOWN	UP/LIFT	IN-SX
M	1888	0	0	5-8
H	1422	0	0	5-8

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW
M	1329	909 / 0
H	1001	683 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.55 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	FACTORED VERT. LOAD (LBS)	MAX. CS (LC)	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)
FR-TO							FR-TO			
A-B	0 / 41	-91.8	-91.8	0.14 (1)	10.00		L-C	0 / 383	0.09 (1)	
B-C	-1847 / 0	-91.8	-91.8	0.34 (1)	4.55		C-K	0 / 310	0.08 (1)	
C-D	-1841 / 0	-91.8	-91.8	0.38 (1)	4.72		K-D	-481 / 0	0.16 (1)	
D-E	-1841 / 0	-91.8	-91.8	0.36 (1)	4.72		K-E	0 / 1010	0.25 (1)	
E-F	-1225 / 0	-91.8	-91.8	0.30 (1)	5.40		I-E	-274 / 0	0.09 (1)	
F-G	0 / 41	-91.8	-91.8	0.14 (1)	10.00		B-L	0 / 1480	0.37 (1)	
M-B	-1926 / 0	0.0	0.0	0.22 (1)	6.01		I-F	0 / 981	0.24 (1)	
H-F	-1380 / 0	0.0	0.0	0.16 (1)	8.88					
M-N	0 / 0	-18.5	-18.5	0.24 (1)	10.00					
N-L	0 / 0	-18.5	-18.5	0.24 (1)	10.00					
L-O	0 / 1424	-18.5	-18.5	0.70 (1)	10.00					
O-K	0 / 1424	-18.5	-18.5	0.70 (1)	10.00					
K-J	0 / 932	-18.5	-18.5	0.29 (1)	10.00					
J-I	0 / 932	-18.5	-18.5	0.29 (1)	10.00					
I-H	0 / 0	-18.5	-18.5	0.04 (4)	10.00					

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	3-10-8	-241	-241	---	---	FRONT	VERT	TOTAL	---	C1
L	3-11-4	-17	-17	---	---	FRONT	VERT	TOTAL	---	C1
N	2-0-12	-17	-17	---	---	FRONT	VERT	TOTAL	---	C1
O	5-6-8	-953	-953	---	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 84 lb

DESIGN CRITERIA	SPECIFIED LOADS:
TOP CH.	LL = 25.6 PSF
	DL = 8.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.55")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.55")
CALCULATED VERT. DEFL.(TL) = L/999 (0.10")
CSI: TC=0.38/1.00 (C-D:1), BC=0.70/1.00 (K-L:1),
WB=0.37/1.00 (B-L:1), SS=0.45/1.00 (K-L:1)
DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00
COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
			788
			1987
			1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (C) (INPUT = 0.90)


JSI METAL= 0.57 (J) (INPUT = 1.00)



Structural component only
DWG# T-2007089

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2018 MTEK Industries, Inc. Sat Apr 25 11:02:55 2020 Page 1
ID:37vF7aG0E03cRUj6X1jSrkzWYK-G?AZmyXBfqFf_Ky|qfukuaTK3fVZXS_cD2RiifVzNCnU

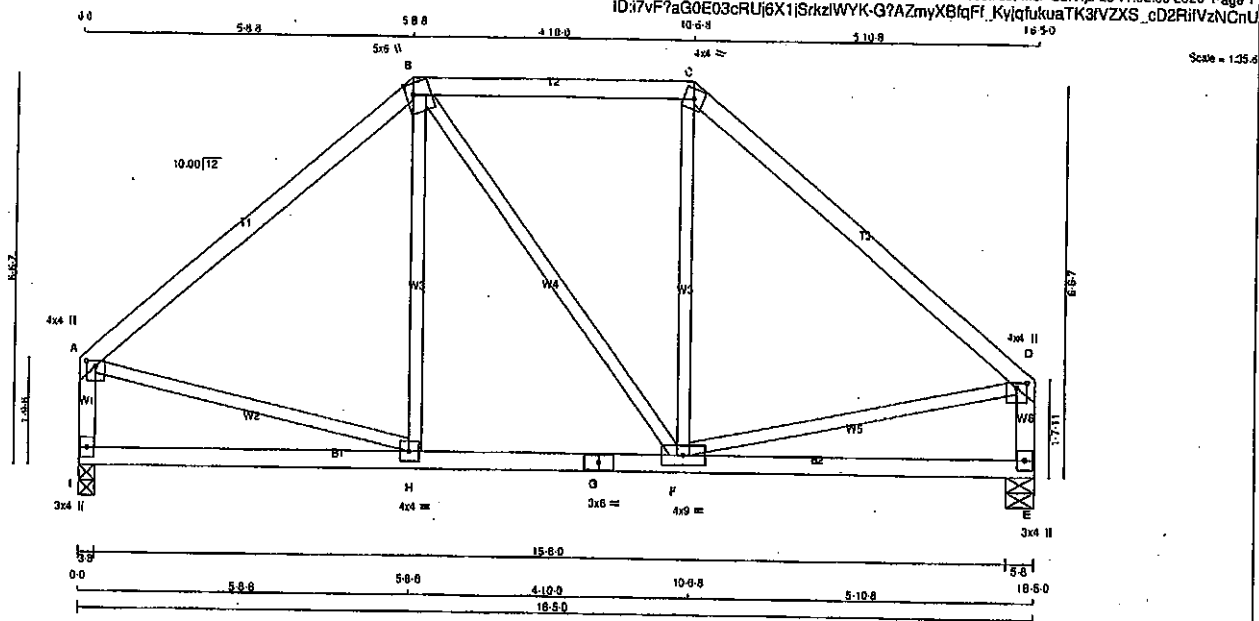

LUMBER				
N. L. G. A. RULES				
CHORDS		SIZE	LUMBER	DESCR
A - B	2x4	DRY	No.2	SPF
B - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
F - G	2x4	DRY	No.2	SPF
G - H	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY
EXCEPT
DRY: SEASONED LUMBER.

PLATES (tablets in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.00	2.00
B	TTWW+m	MT20	5.0	6.0	2.25	1.50
C	TTW-m	MT20	4.0	4.0		
D	TMVW+p	MT20	4.0	4.0	1.00	2.00
E	BMV1+p	MT20	3.0	4.0		
F	BMWVW-t	MT20	4.0	9.0		
G	BS-t	MT20	3.0	6.0		
H	BMWV-t	MT20	4.0	4.0		
I	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER
BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
I	905	0	905	0	0	3-0	3-8
E	905	0	905	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	840	420 / 0	0 / 0	0 / 0	0 / 0	220 / 0	0 / 0
E	840	420 / 0	0 / 0	0 / 0	0 / 0	220 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I. E.

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBB			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	-718 / 0	-91.8	-91.8 0.39 (1)	8.25	H-B	-34 / 68	0.02 (4)
B-C	-558 / 0	-91.8	-91.8 0.28 (1)	6.25	F-B	0 / 14	0.00 (1)
C-D	-729 / 0	-91.8	-91.8 0.42 (1)	8.25	F-C	-23 / 74	0.03 (4)
I-A	-860 / 0	0.0	0.0 0.09 (1)	7.81	A-H	0 / 587	0.13 (1)
E-D	-858 / 0	0.0	0.0 0.09 (1)	7.81	F-D	0 / 572	0.13 (1)
I-H	0 / 0	-18.5	-18.5 0.13 (4)	10.00			
H-G	0 / 550	-18.5	-18.5 0.18 (4)	10.00			
G-F	0 / 550	-18.5	-18.5 0.18 (4)	10.00			
F-E	0 / 0	-18.5	-18.5 0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING $\approx$ 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= $L/360$ (0.55")
 CALCULATED VERT. DEFL.(LL) = $L/999$ (0.01")
 ALLOWABLE DEFL.(TL)= $L/360$ (0.55")
 CALCULATED VERT. DEFL.(TL) = $L/999$ (0.05")

CSI: TC=0.42/1.00 (C-D:1), BC=0.18/1.00 (F-H:4),
WB=0.13/1.00 (D-F:1), SSI=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS 8END=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	818	354	1667	788	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (D) (INPUT = 0.90)
JSI METAL= 0.24 (D) (INPUT = 1.00)




Structural component only
DWG# T-2007070

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	ORWG NO.
408150	T8	1	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 11:02:56 2020 Page 1
ID:7vF7aG0E03cRUjSX1SrKzWYK-iBkxziYpQ8NWcUXvNNPzRo0YI3nGGpIRIAFBzNCnT

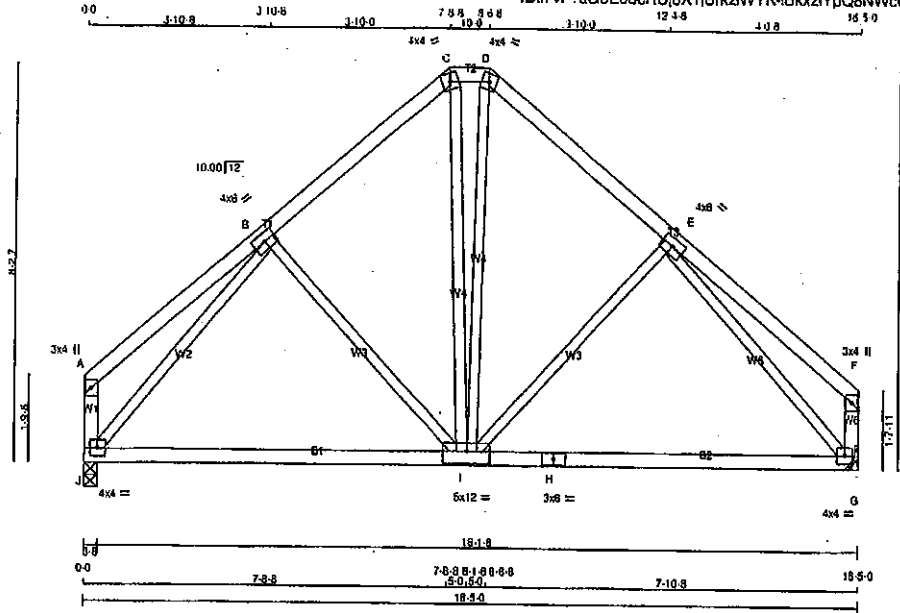

Scale = 1/4\"/>

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
J - A	2x4	DRY	No.2
G - F	2x4	DRY	No.2
J - H	2x4	DRY	No.2
H - G	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B	TMWW-t	MT20	4.0	8.0		
C	TTW-m	MT20	4.0	4.0		
D	TTW-m	MT20	4.0	4.0		
E	TMWW-t	MT20	4.0	8.0		
F	TMV+p	MT20	3.0	4.0		
G	BMVW1-t	MT20	4.0	4.0		
H	BS-t	MT20	3.0	8.0		
I	BMWWWW-t	MT20	5.0	12.0	3.00	6.00
J	BMVW1-t	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED	MAXIMUM FACTORED	INPUT	REQD			
	GROSS REACTION	GROSS REACTION	BRG	BRG			
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
J	905	0	905	0	0	3-8	3-8
G	905	0	905	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	640	420 / 0	0 / 0	0 / 0	0 / 0	220 / 0	0 / 0
G	840	420 / 0	0 / 0	0 / 0	0 / 0	220 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO		FROM TO	LENGTH	FR-TO		FROM TO	LENGTH
A-B	0 / 27	-91.8	-91.8 0.22 (1)	10.00	B-I	-163 / 0	0.11 (1)
B-C	-649 / 0	-91.8	-91.8 0.17 (1)	8.25	I-E	-190 / 0	0.13 (1)
C-D	-489 / 0	-91.8	-91.8 0.01 (1)	8.25	J-B	-930 / 0	0.54 (1)
D-E	-650 / 0	-91.8	-91.8 0.18 (1)	8.25	E-G	-935 / 0	0.57 (1)
E-F	0 / 27	-91.8	-91.8 0.23 (1)	10.00	C-I	0 / 221	0.05 (1)
J-A	-129 / 0	0.0	0.0 0.01 (1)	7.81	I-D	0 / 222	0.05 (1)
G-F	-137 / 0	0.0	0.0 0.01 (1)	7.81			
J-I	0 / 590	-18.5	-18.5 0.41 (4)	10.00			
I-H	0 / 608	-18.5	-18.5 0.41 (4)	10.00			
H-G	0 / 608	-18.5	-18.5 0.41 (4)	10.00			

TOTAL WEIGHT = 77 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 080-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.55")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.55")
CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CSI: TC=0.23/1.00 (E-F:1), BC=0.41/1.00 (G-I:4), WB=0.57/1.00 (E-G:1), SS=0.13/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1887
	788	1987	1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.75 (G) (INPUT = 0.90)
JSI METAL= 0.23 (G) (INPUT = 1.00)

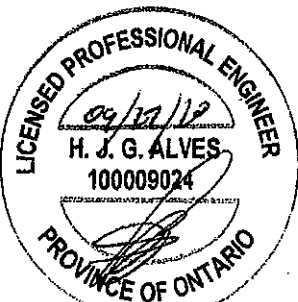


Structural component only
DWG# T-2007071

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Sat Apr 25 11:02:57 2020 Page 1
ID:7vF?aG0E03cRUj6X1jSrKzIWK-DOHJBeZRBVSNEe65x4wCz?ZjsTBi?LQvgMwojNzNCnS

Scale = 1:18.4

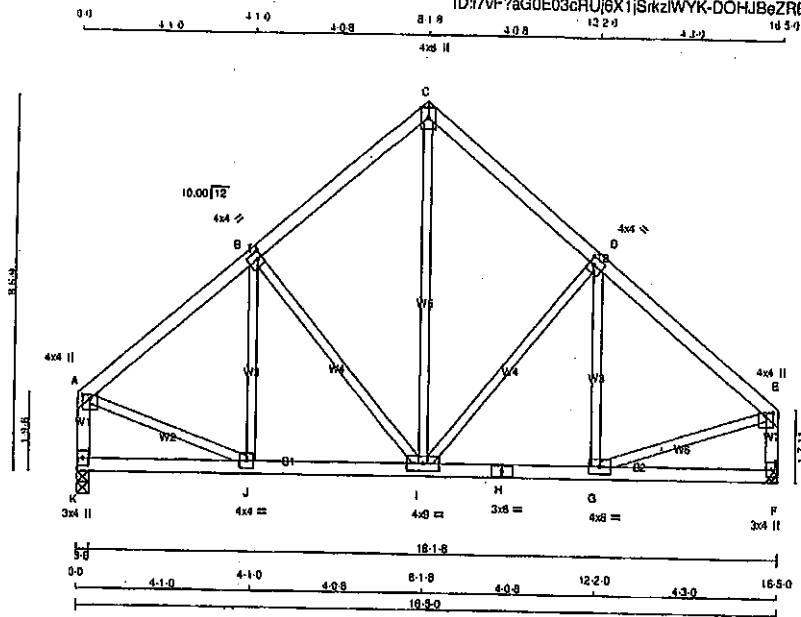

LUMBER			
N. L. G. A. RULES			
CHORDS		SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
K - A	2x4	DRY	No.2
F - E	2x4	DRY	No.2
K - H	2x4	DRY	No.2
H - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY
EXCEPT
DRY: SEASONED LUMBER

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMWV+p	MT20	4.0	4.0	1.00 2.00
B	TMWV-t	MT20	4.0	4.0	2.00 1.25
C	TTW+p	MT20	4.0	8.0	Edge
D	TMWV-t	MT20	4.0	4.0	2.00 1.25
E	TMWV+p	MT20	4.0	4.0	1.00 2.00
F	BMV1+p	MT20	3.0	4.0	
G	BMWV-t	MT20	4.0	6.0	
H	BS-t	MT20	3.0	6.0	
I	BMWVWV-t	MT20	4.0	9.0	
J	BMWV-t	MT20	4.0	4.0	
K	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION			MAXIMUM FACTORED GROSS REACTION			INPUT	REQD
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	BRG	
JT	905	0	905	0	0	3-8		3-8	
K	905	0	905	0	0				
F	905	0	905	0	0		MECHANICAL		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3'-8".

UNFACTORED REACTIONS

1ST CASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	840	420 / 0	0 / 0	0 / 0	0 / 0	220 / 0	0 / 0
F	840	420 / 0	0 / 0	0 / 0	0 / 0	220 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBBS				
MAX. FACTORED		FACTORED			MAX. FACTORED		FACTORED		
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX. CSI (LC)		
FR-TO		FROM TO			FR-TO				
A-B	-772 / 0	-91.8	-91.8	0.20 (1)	8.25	J-B	-135 / 21	0.05 (1)	
B-C	-620 / 0	-91.8	-91.8	0.19 (1)	8.25	J-B	-251 / 0	0.18 (1)	
C-D	-622 / 0	-91.8	-91.8	0.20 (1)	8.25	I-C	0 / 478	0.11 (1)	
D-E	-795 / 0	-91.8	-91.8	0.21 (1)	8.25	I-D	-278 / 0	0.20 (1)	
K-A	-873 / 0	0.0	0.0	0.10 (1)	7.81	G-D	-110 / 31	0.04 (1)	
F-E	-872 / 0	0.0	0.0	0.08 (1)	7.81	A-J	0 / 653	0.15 (1)	
						G-E	0 / 682	0.15 (1)	
K-J	0 / 0	-18.5	-18.5	0.07 (4)	10.00				
J-I	0 / 615	-18.5	-18.5	0.13 (1)	10.00				
I-H	0 / 633	-18.5	-18.5	0.14 (1)	10.00				
H-G	0 / 633	-18.5	-18.5	0.14 (1)	10.00				
G-F	0 / 0	-18.5	-18.5	0.07 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL	= 25.6	PSF
	DL	= 8.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= $L/360$ (0.55")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.02")
ALLOWABLE DEFL.(TL)= $L/360$ (0.55")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.03")

CSI: TC=0.21/1.00 (D-E:1), BC=0.14/1.00 (G-I:1),

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1867	788	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (E) (INPUT = 0.90)
JSI METAL= 0.24 (E) (INPUT = 1.00)




Structural component only
DWG# T-2007072

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408150	T10S	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 2019 Mitek Industries, Inc. Sat Apr 25 11:02:58 2020 Page 1
ID:7vF7aG0E03cRUj6X1jSikzIWK-hariO_a4yldDroHlVvRRW05vyIX_kqu2v0IMFpzNCnR

Scale = 1:33.9

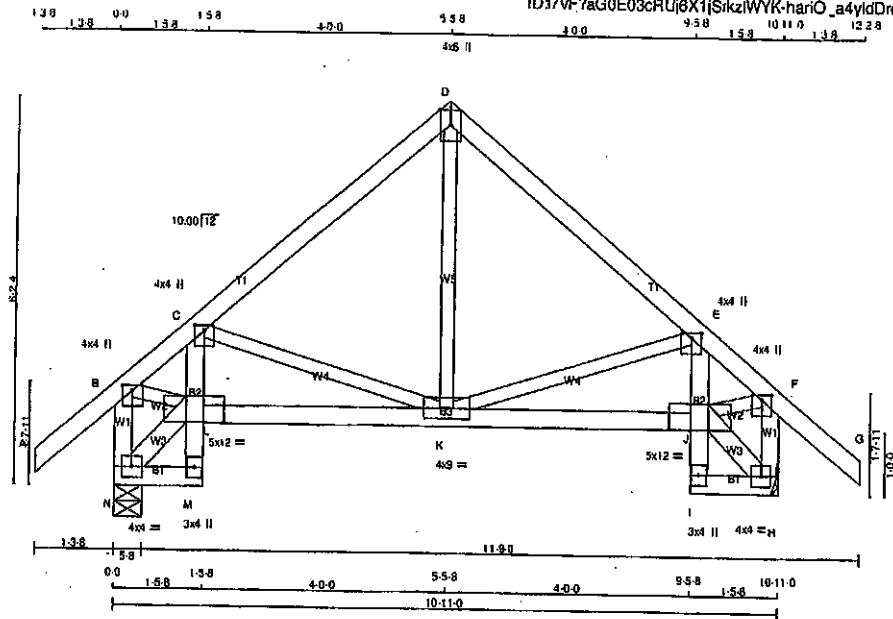

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
N - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
N - M	2x4	DRY	No.2
M - C	2x4	DRY	No.2
L - J	2x4	DRY	No.2
I - E	2x4	DRY	No.2
I - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
N - L	2x4	DRY	No.2
J - H	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B, C, E, F					
B - TMVW+p	MT20	4.0	4.0	1.00	2.00
D - TTW+p	MT20	4.0	8.0	Edge	
H - BMVW1-i	MT20	4.0	4.0		
I - BMV+p	MT20	3.0	4.0		
J - BVMWW-i	MT20	5.0	12.0	5.00	7.75
K - BMVWW-i	MT20	4.0	9.0		
L - BVMWW-i	MT20	5.0	12.0	5.00	7.75
M - BMV+p	MT20	3.0	4.0		
N - BMVW1-i	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BRG	BRG
N	729	0	729	0	0	5-8	5-8		
H	729	0	729	0	0	MECHANICAL			

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 1-8.

UNFACTORED REACTIONS

JT	1ST LOASE	MAX/MIN. COMPONENT REACTIONS						
N	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
N	513	350 / 0	0 / 0	0 / 0	0 / 0	163 / 0	0 / 0	
H	513	350 / 0	0 / 0	0 / 0	0 / 0	163 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LCI MAX	MEMB.	FORCE (LBS)	VERT. LOAD	LCI MAX
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 41	-91.8	-91.8 0.13 (1)	C-K	-211 / 0	0.07 (1)	
B-C	-847 / 0	-91.8	-91.8 0.14 (1)	K-D	0 / 229	0.05 (1)	
C-D	-447 / 0	-91.8	-91.8 0.18 (1)	K-E	-210 / 0	0.07 (1)	
D-E	-447 / 0	-91.8	-91.8 0.18 (1)	N-L	-26 / 0	0.00 (1)	
E-F	-846 / 0	-91.8	-91.8 0.14 (1)	B-L	0 / 527	0.12 (1)	
F-G	0 / 41	-91.8	-91.8 0.13 (1)	J-F	0 / 526	0.12 (1)	
N-B	-701 / 0	0.0	0.0 0.07 (1)	J-H	-26 / 0	0.00 (1)	
H-F	-701 / 0	0.0	0.0 0.07 (1)				
N-M	0 / 20	-18.5	-18.5 0.01 (4)				
M-L	0 / 14	0.0	0.0 0.03 (1)				
L-C	-82 / 2	0.0	0.0 0.02 (1)				
L-K	0 / 528	-18.5	-18.5 0.13 (1)				
K-J	0 / 627	-18.5	-18.5 0.13 (1)				
I-J	0 / 14	0.0	0.0 0.03 (1)				
J-E	-93 / 2	0.0	0.0 0.02 (1)				
I-H	0 / 20	-18.5	-18.5 0.01 (4)				

TOTAL WEIGHT = 2 X 56 = 112 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/G

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, CBC 2012, ABC 2018
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.38")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.01")
ALLOWABLE DEFL.(TL) = $L/360$ (0.38")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.02")

CSI: TC=0.19/1.00 (C-D:1), SC=0.13/1.00 (K-L:1),
WB=0.12/1.00 (B-L:1), SSI=0.13/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 516 354 1667 788 1907 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.74 (F) (INPUT = 0.90)
JSI METAL = 0.20 (F) (INPUT = 1.00)

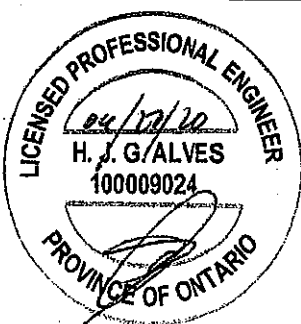

Structural component only
DWG# T-2007073

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408150	T11	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

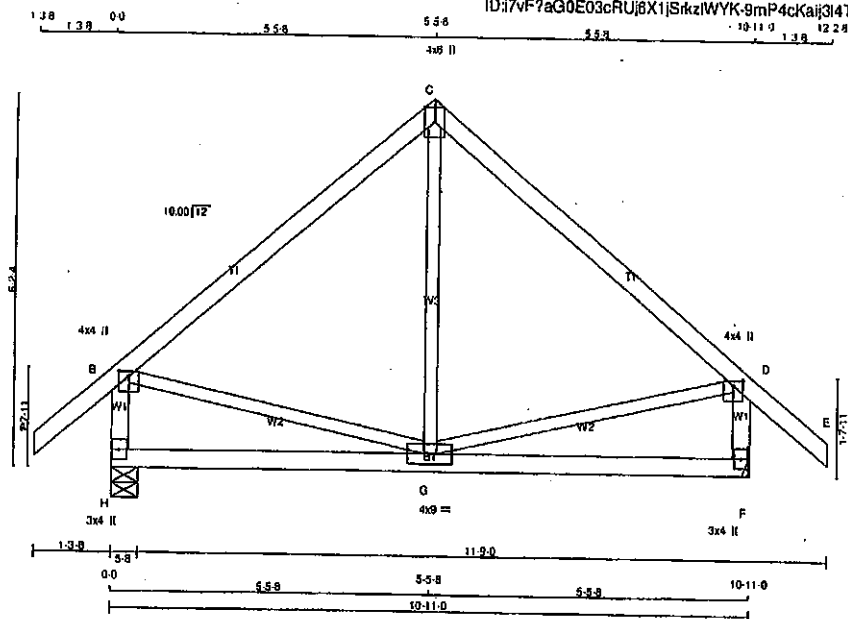

Scale = 1/32"

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
F - D	2x4	DRY	No.2
H - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
C	TTW+p	MT20	4.0	6.0	Edge
D	TMVW+p	MT20	4.0	4.0	1.00 2.00
F	BMV1+p	MT20	3.0	4.0	
G	BMVWW+1	MT20	4.0	9.0	
H	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS	REACT	GROSS	REACT	BRG	BRG	IN-SX	IN-SX
H	729	0	729	0	0	5-8	5-8		
F	729	0	729	0	0	MECHANICAL			

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

1ST CASE		MAX/MIN COMPONENT REACTIONS		PERM/LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM	LIVE	WIND	WIND	DEAD	DEAD	SOIL	SOIL
H	513	350/0	0/0	0/0	0/0	0/0	163/0	0/0	0/0	0/0	0/0
F	513	350/0	0/0	0/0	0/0	0/0	163/0	0/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	MAX. CSI (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0/41	-91.8	-91.8 0.13 (1)	10.00	G-C	-15/89	0.03 (4)
B-C	-380/0	-91.8	-91.8 0.35 (1)	6.25	B-G	0/300	0.07 (1)
C-D	-380/0	-91.8	-91.8 0.35 (1)	6.25	G-D	0/300	0.07 (1)
D-E	0/41	-91.8	-91.8 0.13 (1)	10.00			
H-B	-890/0	0.0	0.0 0.07 (1)	7.81			
F-D	-890/0	0.0	0.0 0.07 (1)	7.81			
H-G	0/0	-18.5	-18.5 0.16 (4)	10.00			
G-F	0/0	-18.5	-18.5 0.16 (4)	10.00			

TOTAL WEIGHT = 49 lb

(M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.36")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.36")
CALCULATED VERT. DEFL. (TL) = L/999 (0.02")

CSI: TC=0.35/1.00 (B-C:1), BC=0.16/1.00 (G-H:4), WB=0.07/1.00 (D-G:1), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1587 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.62 (D) (INPUT = 0.90)
JSI METAL = 0.17 (D) (INPUT = 1.00)

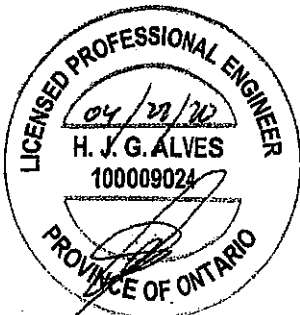


Structural component only
DWG# T-2007074

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408150	T12	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:03:01 2020 Page 1
ID:4NxGft_xHSHnsgnSWZu6izNuP6-59Xq17cyEg?oiFQsAw788jPP4ZbxCqUb_u0s8zNCnO

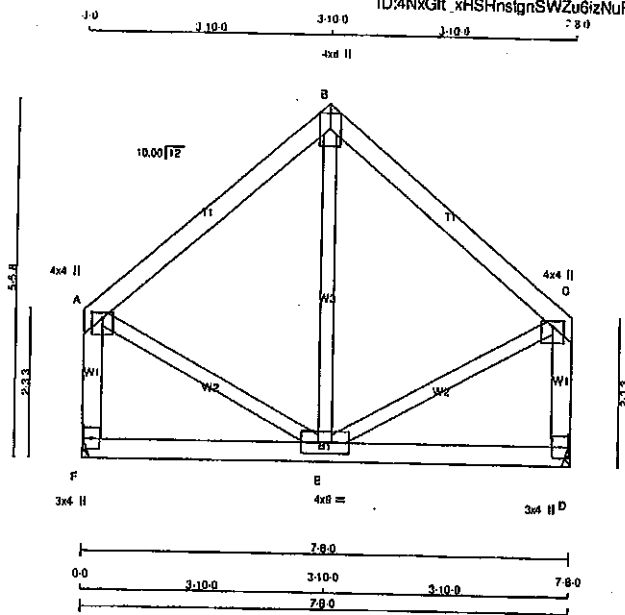

Scale = 1/32" = 1'-0"

<u>LUMBER</u>				
N. L. G. A. RULES				
CHORDS		SIZE	LUMBER	DESCR
A - B	2x4	DRY	No.2	SPF
B - C	2x4	DRY	No.2	SPF
F - A	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (Table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.00	2.00
B	TTW+p	MT20	4.0	8.0	Edge	
C	TMVW+p	MT20	4.0	4.0	1.00	2.00
D	BMV1+p	MT20	3.0	4.0		
E	BMVWW-1	MT20	4.0	9.0		
F	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
F	423	423	0	0
D	423	423	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F, D. MINIMUM BEARING LENGTH AT JOINT F = 1-8, JOINT D = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	299	198 / 0	0 / 0	0 / 0	0 / 0	103 / 0	0 / 0
D	299	198 / 0	0 / 0	0 / 0	0 / 0	103 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORZ. LOAD (LC)	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORZ. LOAD (LC)
FR-TO						FR-TO				
A-B		-214 / 0	-91.8	-91.8	0.17 (1)	E-B		-78 / 37	0.03 (1)	
B-C		-214 / 0	-91.8	-91.8	0.17 (1)	A-E		0 / 184	0.04 (1)	
F-A		-395 / 0	0.0	0.0	0.05 (1)	E-C		0 / 184	0.04 (1)	
D-C		-395 / 0	0.0	0.0	0.05 (1)					
F-E		0 / 0	-18.5	-18.5	0.06 (4)					
E-D		0 / 0	-18.5	-18.5	0.06 (4)					

TOTAL WEIGHT = 35 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.8 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.26")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.26")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.17/1.00 (B-C:1), BC=0.08/1.00 (D-E:4),
WB=0.04/1.00 (A-E:1), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	518	354	1687
	788	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.31 (C) (INPUT = 0.90)
JSI METAL= 0.09 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007075

JOB NAME 408150	TRUSS NAME T12S	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

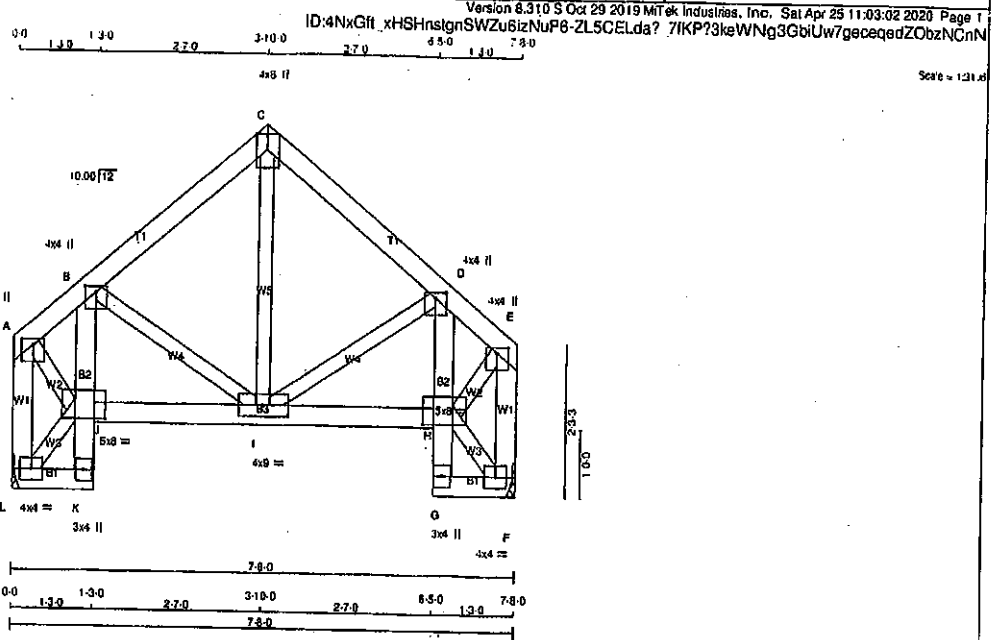

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
L - A	2x4	DRY	No.2
F - E	2x4	DRY	No.2
L - K	2x4	DRY	No.2
K - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
G - D	2x4	DRY	No.2
G - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A, B, D, E						
A	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTW+p	MT20	4.0	8.0	Edge	
F	BMVW1-t	MT20	4.0	4.0		
G	BMV+p	MT20	3.0	4.0		
H	BMVWW-1	MT20	5.0	8.0	3.50	5.50
I	BMVWW-1	MT20	4.0	9.0		
J	BMVWW-1	MT20	5.0	8.0	3.50	5.50
K	BMV+p	MT20	3.0	4.0		
L	BMVW1-t	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
L	423	0	423	0	0
F	423	0	423	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT L, F. MINIMUM BEARING LENGTH AT JOINT L = 1-8, JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST LOSE	MAX/MIN COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	299	196 / 0	0 / 0	0 / 0	0 / 0	0 / 0	103 / 0	0 / 0
F	299	196 / 0	0 / 0	0 / 0	0 / 0	0 / 0	103 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	-282 / 0	I-C	0 / 125
B-C	-274 / 0	I-D	-57 / 0
C-D	-274 / 0	B-I	-57 / 0
D-E	-282 / 0	L-J	-13 / 0
L-A	-404 / 0	A-J	0 / 317
F-E	-404 / 0	H-E	-13 / 0
L-K	0 / 9	H-E	0 / 317
K-J	0 / 11		
J-B	-182 / 0		
J-I	0 / 247		
I-H	0 / 247		
G-H	0 / 11		
H-D	-182 / 0		
G-F	0 / 9		

TOTAL WEIGHT = 2 X 43 = 86 lb (MRF)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $\frac{1}{380}$ (0.26")
CALCULATED VERT. DEFL.(LL) = $\frac{1}{989}$ (0.00")
ALLOWABLE DEFL.(TL) = $\frac{1}{380}$ (0.26")
CALCULATED VERT. DEFL.(TL) = $\frac{1}{989}$ (0.01")

CSI: TC=0.07/1.00 (C-D:1), BC=0.08/1.00 (H-I:1), WB=0.07/1.00 (A-J:1), SS=0.09/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.30 (E) (INPUT = 0.90)
JSI METAL= 0.08 (E) (INPUT = 1.00)

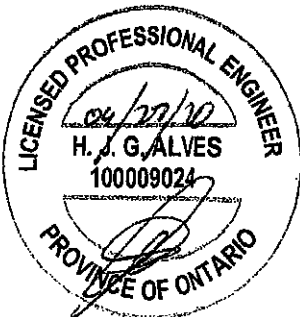


Structural component only
DWG# T-2007076

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408150	T15	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 3.310 5 Oct 2019 MTEK Industries, Inc. Sat Apr 25 11:03:03 2020 Page 1
ID:7vF7aG0E03cRU6X1jSkzIWYK-1XibSheCmIFWYzAFIL1cDGphHuDpP_en2IN7x1zNCnM

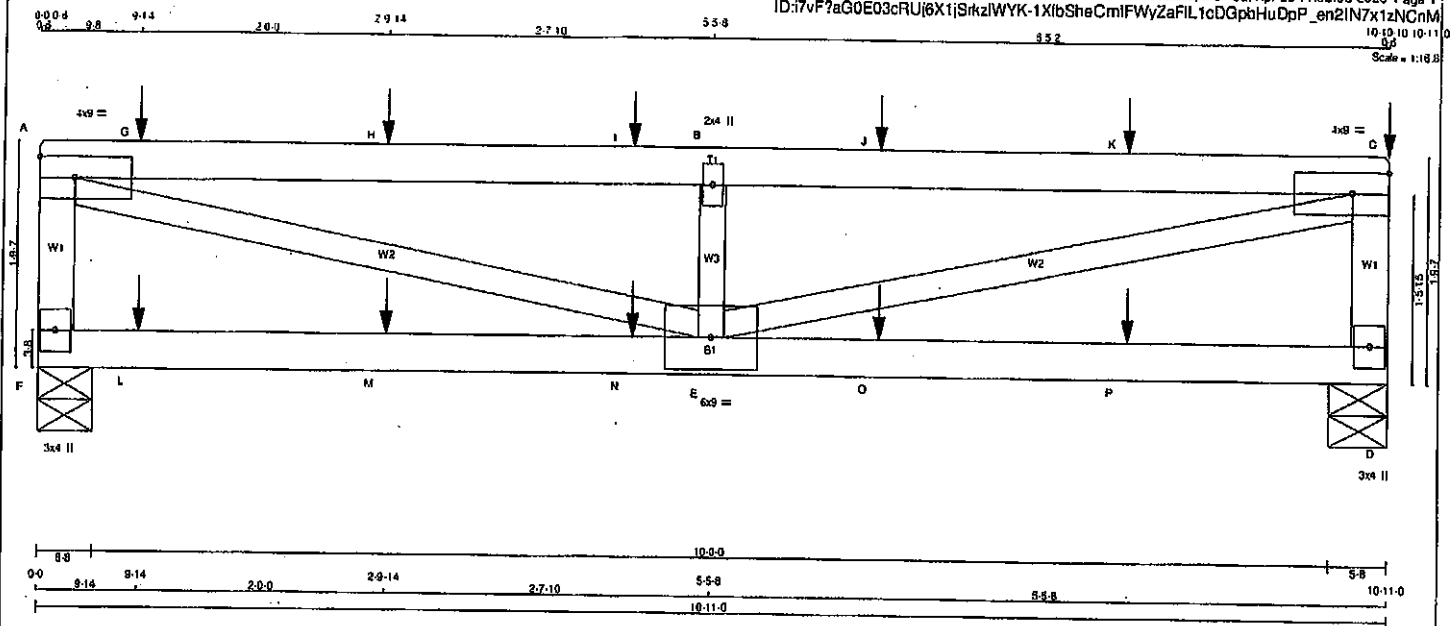

LUMBER	CHORDS	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES	A - C	2x4	DRY	No.2	SPF
	F - A	2x4	DRY	No.2	SPF
	D - C	2x4	DRY	No.2	SPF
	F - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	V	X
A	TMW-I	MT20	4.0	9.0		Edge
B	TMW-w	MT20	2.0	4.0		
C	TMW-I	MT20	4.0	9.0		Edge
D	BMV-I-p	MT20	3.0	4.0		
E	BMWW-I	MT20	8.0	9.0		
F	BMV-I-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
F	976	0	976	0
D	1015	0	1015	0

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS	PERM	LIVE	WIND	DEAD	SOIL
F	690	453 / 0	0 / 0	0 / 0	0 / 0	0 / 0	237 / 0	0 / 0
D	716	479 / 0	0 / 0	0 / 0	0 / 0	0 / 0	237 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.56 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LOC	MAX	MAX	WEBS	MAX. FACTORED	MAX
		(LBS)	(LBS)	(PLF)	(LC)	(LC)	(LC)		(LBS)	(LC)
F-R	TO							FR-TO		
A-G	-2081 / 0	-91.8	-91.8	0.79 (1)	3.55	A-E	0 / 2157	0.93 (1)		
G-H	-2081 / 0	-91.8	-91.8	0.79 (1)	3.55	E-B	-878 / 0	0.14 (1)		
H-I	-2081 / 0	-91.8	-91.8	0.79 (1)	3.55	E-C	0 / 2157	0.93 (1)		
I-B	-2081 / 0	-91.8	-91.8	0.79 (1)	3.55					
B-J	-2081 / 0	-91.8	-91.8	0.79 (1)	3.55					
J-K	-2081 / 0	-91.8	-91.8	0.79 (1)	3.55					
K-C	-2081 / 0	-91.8	-91.8	0.79 (1)	3.55					
F-A	-889 / 0	0.0	0.0	0.10 (1)	7.81					
D-C	-938 / 0	0.0	0.0	0.11 (1)	7.81					
F-L	0 / 0	-18.5	-18.5	0.22 (4)	10.00					
L-M	0 / 0	-18.5	-18.5	0.22 (4)	10.00					
M-N	0 / 0	-18.5	-18.5	0.22 (4)	10.00					
N-E	0 / 0	-18.5	-18.5	0.22 (4)	10.00					
E-O	0 / 0	-18.5	-18.5	0.22 (4)	10.00					
O-P	0 / 0	-18.5	-18.5	0.22 (4)	10.00					
P-D	0 / 0	-18.5	-18.5	0.22 (4)	10.00					

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LOC	MAX	MAX	FACE	DIR.	TYPE	HEEL	CONN.
C	10-11-0	-123	-123	---	BACK	VERT	TOTAL	---	C1
G	9-14	-80	-80	---	BACK	VERT	TOTAL	---	C1
H	2-9-14	-82	-82	---	BACK	VERT	TOTAL	---	C1
I	4-9-14	-82	-82	---	BACK	VERT	TOTAL	---	C1
J	6-9-14	-82	-82	---	BACK	VERT	TOTAL	---	C1
K	8-9-14	-82	-82	---	BACK	VERT	TOTAL	---	C1
L	9-14	-51	-51	---	BACK	VERT	TOTAL	---	C1
M	2-9-14	-49	-49	---	BACK	VERT	TOTAL	---	C1
N	4-9-14	-49	-49	---	BACK	VERT	TOTAL	---	C1
O	6-9-14	-49	-49	---	BACK	VERT	TOTAL	---	C1
P	8-9-14	-49	-49	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.36")
CALCULATED VERT. DEFL.(LL) = 1.959 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.36")
CALCULATED VERT. DEFL.(TL) = 1.817 (0.18")

CSI: TC=0.79/1.00 (A-B:1), BC=0.22/1.00 (E-F:4),
WB=0.53/1.00 (A-E:1), SS=0.39/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MT20	618	354	1687
	788	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (A) (INPUT = 0.90)
JSI METAL= 0.40 (E) (INPUT = 1.00)

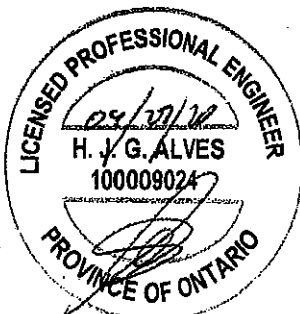

Structural component only
DWG# T-2007077

JOB NAME 408151	TRUSS NAME T20	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 26 11:19:44 2020 Page 1		
ID:h2dflgC44ws_E2l2qPs_atzllRw-E6e7Xz51rNUYObR4VLHMmIPQOSi27EXM6ZWzNCX				Scale = 1:57.3		

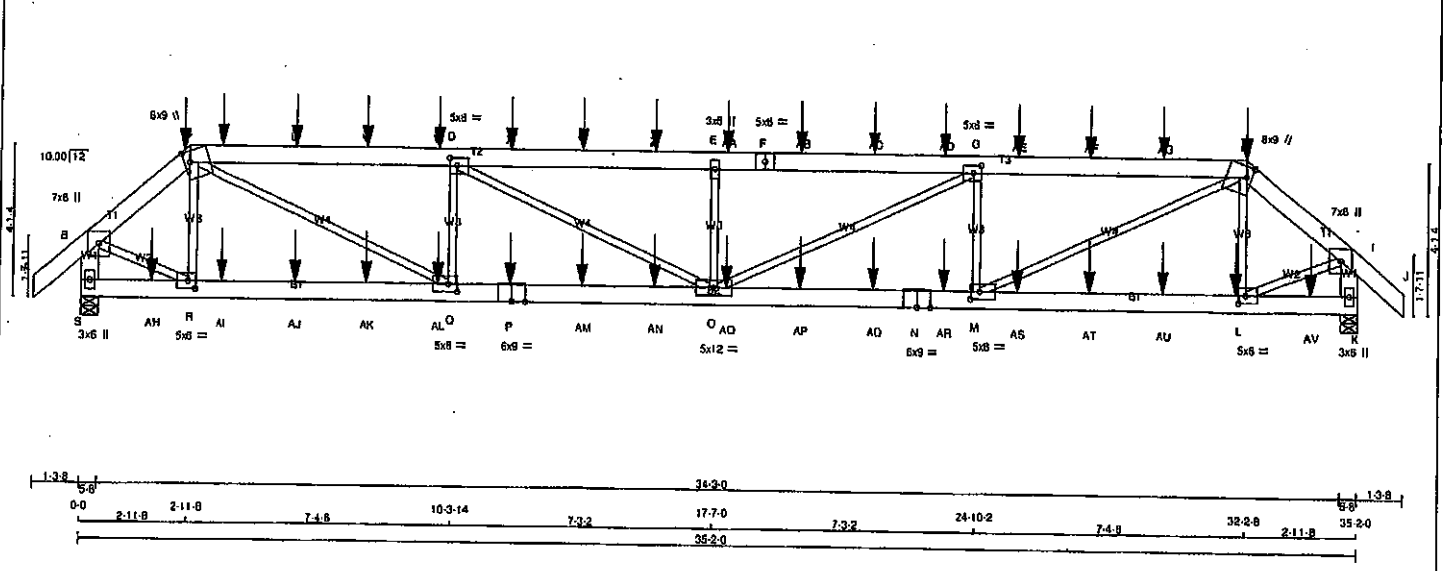

LUMBER				
N. L. G. A. RULES				
CHORDS		SIZE	LUMBER	DESCR.
A - C	2x8	DRY	No.2	SPF
C - F	2x8	DRY	No.2	SPF
F - H	2x8	DRY	No.2	SPF
H - J	2x8	DRY	No.2	SPF
S - B	2x8	DRY	No.2	SPF
K - I	2x8	DRY	No.2	SPF
S - P	2x8	DRY	1650F 1.5E	SPF
P - N	2x8	DRY	1650F 1.6E	SPF
N - K	2x8	DRY	1650F 1.5E	SPF

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ORWG NO.
408151	T20	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:19:44 2020 Page 2
ID:h2dflgC44wS E2bzqPs atzllRw-E6e7Xz51rNUYObeR4VLHmIP0oOS27EXMbZWzNCX

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW+p	MT20	7.0	8.0		
C	TTWW+m	MT20	8.0	9.0	3.50	1.75
D	TMWW-t	MT20	5.0	6.0	2.50	2.50
E	TMWW+w	MT20	3.0	8.0		
F	TS-t	MT20	5.0	6.0		
G	TMWW-t	MT20	5.0	8.0	2.50	2.50
H	TTWW+m	MT20	8.0	9.0	3.50	1.75
I	TMWW+p	MT20	7.0	8.0		
K	BMV1+p	MT20	3.0	8.0		
L	BMWW-t	MT20	5.0	6.0	2.50	2.25
M	BMWW-t	MT20	5.0	8.0	2.50	3.00
N	BS-t	MT20	8.0	9.0		
O	BMWWWW-t	MT20	5.0	12.0		
P	BS-t	MT20	6.0	9.0		
Q	BMWW-t	MT20	5.0	8.0	2.50	3.00
R	BMWW-t	MT20	5.0	6.0	2.50	2.25
S	BMV1+p	MT20	3.0	6.0		

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO		FR-TO		
M-AS	0/2579	-18.5	-18.5 0.18 (1)	10.00			
AS-AT	0/2579	-18.5	-18.5 0.18 (1)	10.00			
AT-AU	0/2579	-18.5	-18.5 0.18 (1)	10.00			
AU-L	0/2579	-18.5	-18.5 0.18 (1)	10.00			
L-AV	0/0	-18.5	-18.5 0.08 (4)	10.00			
AV-K	0/0	-18.5	-18.5 0.08 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	2-11-8	-38	-42	---	FRONT	VERT	DEAD	---	C1
C	2-11-8	-191	-191	---	FRONT	VERT	SNOW	---	C1
H	32-2-8	-38	-42	---	FRONT	VERT	DEAD	---	C1
H	32-2-8	-116	-118	---	FRONT	VERT	TOTAL	---	C1
H	32-2-8	-191	-191	---	FRONT	VERT	SNOW	---	C1
L	31-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
P	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	3-11-4	-111	-111	---	FRONT	VERT	TOTAL	---	C1
U	5-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	17-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	19-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	21-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	23-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	25-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	27-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AG	29-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AH	1-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AL	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AM	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AN	15-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AO	17-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AP	19-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AQ	21-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AR	23-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AS	25-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AT	27-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AU	29-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AV	33-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1


CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2007081 3/2

!DRWG NO.



JSI GRIP= 0.88 (D) (INPUT = 0.90)
JSI METAL= 0.84 (P) (INPUT = 1.00)



JOB NAME 408151	TRUSS NAME T20Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington


Version 8.310 S Oct 29 2019 Mitex Industries, Inc. Sat Apr 28 11:19:45 2020 Page 2
ID:12d1gC44wS E21zqPs_atzIRw-UCOUmk09VL9YAq n0aqaJuZo4E85KGTB585vzNCX

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	7.0	8.0		
C	TTWW+m	MT20	8.0	9.0	3.50	1.75
D	TMWW-t	MT20	5.0	6.0	2.50	2.50
E	TMW+w	MT20	3.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMWW-t	MT20	5.0	6.0	2.50	2.50
H	TTWW+m	MT20	8.0	9.0	3.50	1.75
I	TMVW+p	MT20	7.0	8.0		
K	BMV1+p	MT20	3.0	6.0		
L	BMWW-t	MT20	5.0	6.0	2.50	2.25
M	BMWW-t	MT20	5.0	6.0	2.50	2.75
N	BS-t	MT20	6.0	9.0		
O	BMWWW-t	MT20	5.0	12.0	2.75	6.00
P	BS-t	MT20	6.0	9.0		
Q	BMWW-t	MT20	5.0	6.0	2.50	2.75
R	BMWW-t	MT20	5.0	6.0	2.50	2.25
S	BMV1+p	MT20	3.0	6.0		

CONNECTION REQUIREMENTS


- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

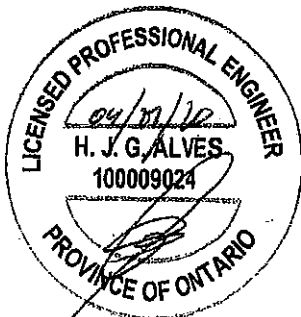

Structural component only
DWG# T-2007082 7/2

JOB NAME 408151	TRUSS NAME T21	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Sat Apr 25 11:19:48 2020 Page 1
ID:h2dflgC44wS_E2t2qPs_atzllRw-AVlmyfmMZdCnll0YUXoMnr1ECRIweZChridOzNCXh
20.3.0 5.3.15 25.6.15 5.3.3 35.2.0 38.5.8 1.3.8
Scale = 1:57.3

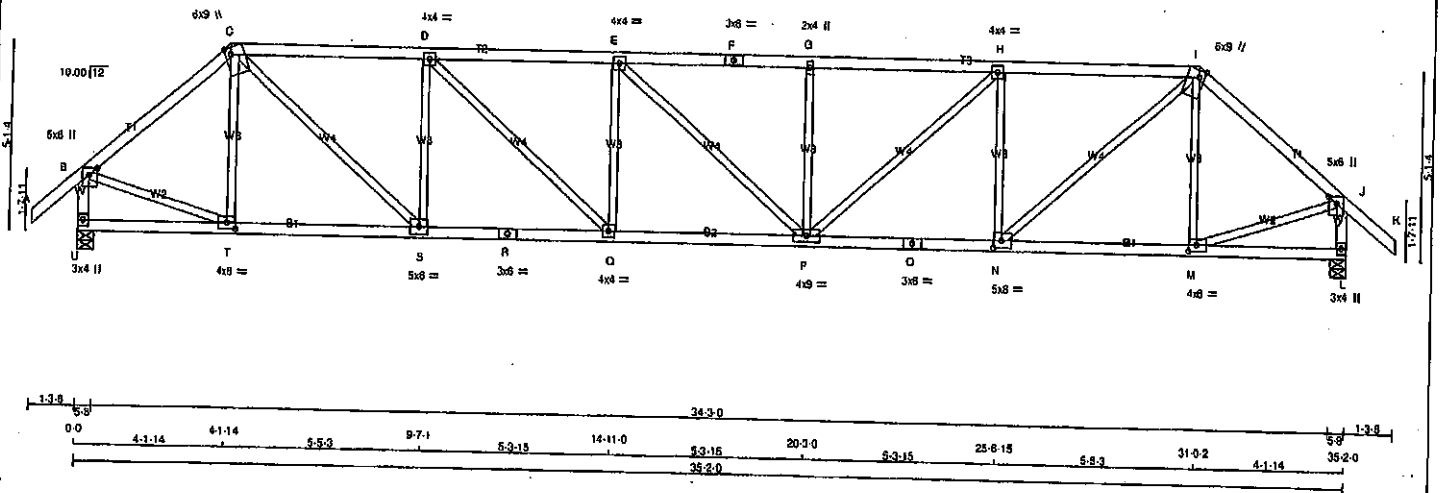

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - K	2x4	DRY	No.2
U - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2

ALL WEBS
EXCEPT

DRY: SEASONED LUMBER.

PLATES (Table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMW+p	MT20	5.0	8.0	Edge 2.75
C	TTWW+m	MT20	6.0	9.0	Edge 1.75
D, E, H					
D	TMWW-t	MT20	4.0	4.0	
F	TS-t	MT20	3.0	6.0	
G	TMW+w	MT20	2.0	4.0	
I	TTWW+m	MT20	6.0	9.0	Edge 1.75
J	TMW+p	MT20	5.0	8.0	Edge 2.75
L	BMV1+p	MT20	3.0	4.0	
M	BMWW-t	MT20	4.0	6.0	2.00 2.75
N	BMWW-t	MT20	5.0	8.0	2.50 2.75
O	BS-t	MT20	3.0	6.0	
P	BMWW-w	MT20	4.0	9.0	
Q	BMWW-t	MT20	4.0	4.0	
R	BS-t	MT20	3.0	6.0	
S	BMWW-t	MT20	5.0	8.0	
T	BMWW-t	MT20	4.0	6.0	2.00 2.75
U	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORIZ	UPLIFT
U	2068	0	0	5-8
L	2068	0	0	5-8

UNFACTORED REACTIONS

1ST CASE	MAX/MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
U	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.20 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	MAX	MEMB.	MAX. FACTORED	FACTORED	MAX
	FORCE (LBS)	VERT. LOAD (LBS)	LC1 MAX		FORCE (LBS)	VERT. LOAD (LBS)	LC1 MAX
FR-TO		FROM TO	CSI (LC)	FR-TO		FROM TO	CSI (LC)
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00	T-C	-358 / 0	0.14 (1)
B-C	-1960 / 0	-91.8	-91.8 0.36 (1)	4.48	C-S	0 / 1836	0.41 (1)
C-D	-2871 / 0	-91.8	-91.8 0.57 (1)	3.59	S-D	-1118 / 0	0.43 (1)
D-E	-3506 / 0	-91.8	-91.8 0.65 (1)	3.21	D-Q	0 / 856	0.19 (1)
E-F	-3505 / 0	-91.8	-91.8 0.59 (1)	3.36	Q-E	-475 / 0	0.18 (1)
F-G	-3505 / 0	-91.8	-91.8 0.59 (1)	3.36	E-P	-2 / 0	0.00 (1)
G-H	-3505 / 0	-91.8	-91.8 0.59 (1)	3.36	P-H	-474 / 0	0.18 (1)
H-I	-2871 / 0	-91.8	-91.8 0.57 (1)	3.59	H-N	0 / 853	0.19 (1)
I-J	-1960 / 0	-91.8	-91.8 0.36 (1)	4.48	N-I	-1117 / 0	0.43 (1)
J-K	0 / 41	-91.8	-91.8 0.13 (1)	10.00	K-I	0 / 1837	0.41 (1)
U-B	-2037 / 0	0.0	0.0 0.22 (1)	5.92	B-T	-358 / 0	0.14 (1)
L-J	-2037 / 0	0.0	0.0 0.22 (1)	5.92	T-J	0 / 1571	0.35 (1)
					M-J	0 / 1571	0.35 (1)
U-T	0 / 0	-18.5	-18.5 0.10 (4)	10.00			
T-S	0 / 1494	-18.5	-18.5 0.30 (1)	10.00			
S-R	0 / 2871	-18.5	-18.5 0.51 (1)	10.00			
R-Q	0 / 2871	-18.5	-18.5 0.51 (1)	10.00			
Q-P	0 / 3508	-18.5	-18.5 0.62 (1)	10.00			
P-O	0 / 2872	-18.5	-18.5 0.51 (1)	10.00			
O-N	0 / 2872	-18.5	-18.5 0.51 (1)	10.00			
N-M	0 / 1494	-18.5	-18.5 0.30 (1)	10.00			
M-L	0 / 0	-18.5	-18.5 0.10 (4)	10.00			

TOTAL WEIGHT = 2 X 147 = 293 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.17)
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.20")
ALLOWABLE DEFL.(TL) = $L/360$ (1.17")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.39")

CSI: TC=0.86/1.00 (G-H:1), BC=0.82/1.00 (P-Q:1),
WB=0.43/1.00 (D-S:1), SS=0.23/1.00 (I-L:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788 1987 1856


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (S) (INPUT = 0.90)
JSI METAL= 0.80 (Q) (INPUT = 1.00)



Structural component only
DWG# T-2007083

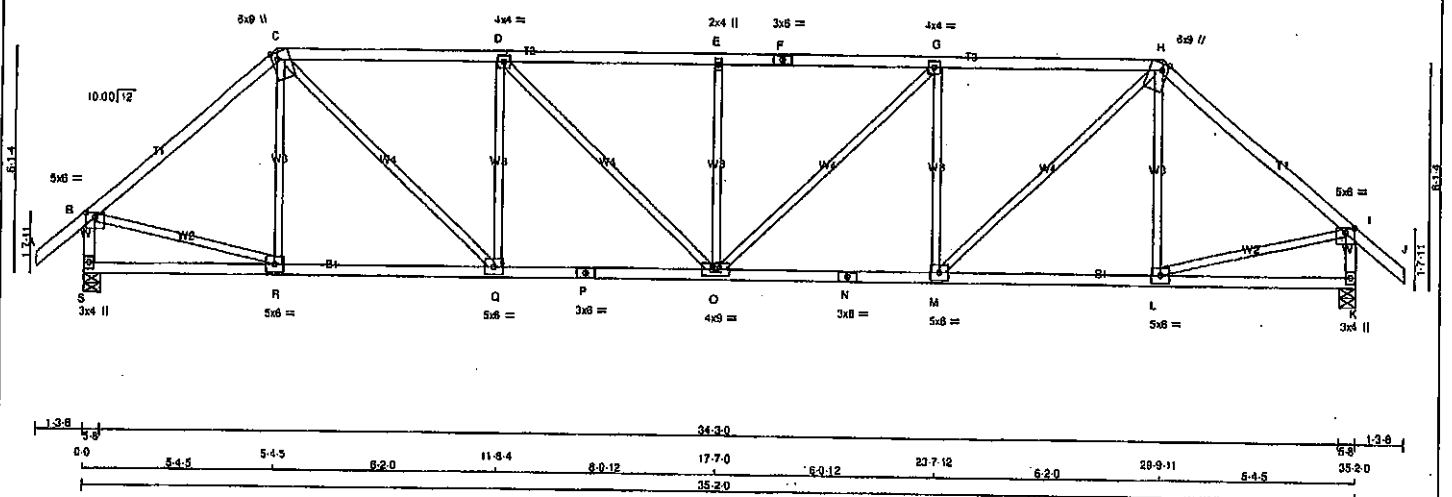

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - J	2x4	DRY	No.2	SPF
S - B	2x4	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF
S - P	2x4	DRY	No.2	SPF
P - N	2x4	DRY	No.2	SPF
N - K	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-p	MT20	5.0	6.0	1.50	3.00
C	TTWW+m	MT20	6.0	9.0	Edge	1.75
D	TMWW-t	MT20	4.0	4.0		
E	TMWW-w	MT20	2.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMWW-t	MT20	4.0	4.0		
H	TTWW+m	MT20	6.0	9.0	Edge	1.75
I	TMWW-p	MT20	5.0	6.0	1.50	3.00
K	BMV1-p	MT20	3.0	4.0		
L, M, Q, R						
L	BMWW-t	MT20	5.0	6.0		
N	BS-t	MT20	3.0	6.0		
O	BMWWW-t	MT20	4.0	9.0		
P	BS-t	MT20	3.0	6.0		
S	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	UP/LIFT		
S	2068	0	2068	0	5-8	5-8
K	2068	0	2068	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
S	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
K	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.28 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX CS1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)	
FR-TO		FROM	TO			FR-TO			
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	R-C	-248 / 7	0.14 (1)	
B-C	-2004 / 0	-91.8	-91.8	0.84 (1)	4.11	C-Q	0 / 1538	0.35 (1)	
C-D	-2653 / 0	-91.8	-91.8	0.74 (1)	3.50	Q-D	-943 / 0	0.55 (1)	
D-E	-2978 / 0	-91.8	-91.8	0.78 (1)	3.28	D-O	0 / 450	0.10 (1)	
E-F	-2978 / 0	-91.8	-91.8	0.78 (1)	3.28	O-E	-513 / 0	0.30 (1)	
F-G	-2978 / 0	-91.8	-91.8	0.78 (1)	3.28	G-O	0 / 450	0.10 (1)	
G-H	-2653 / 0	-91.8	-91.8	0.74 (1)	3.50	M-G	-943 / 0	0.55 (1)	
H-I	-2004 / 0	-91.8	-91.8	0.84 (1)	4.11	M-H	0 / 1538	0.35 (1)	
I-J	0 / 41	-91.8	-91.8	0.13 (1)	10.00	L-H	-248 / 7	0.14 (1)	
S-B	-2028 / 0	0.0	0.0	0.22 (1)	5.94	B-R	0 / 1580	0.38 (1)	
K-I	-2028 / 0	0.0	0.0	0.22 (1)	5.94	L-I	0 / 1580	0.38 (1)	
S-R	0 / 0	-18.5	-18.5	0.14 (4)	10.00				
R-Q	0 / 1532	-18.5	-18.5	0.33 (1)	10.00				
Q-P	0 / 2653	-18.5	-18.5	0.49 (1)	10.00				
P-O	0 / 2653	-18.5	-18.5	0.49 (1)	10.00				
O-N	0 / 2653	-18.5	-18.5	0.49 (1)	10.00				
N-M	0 / 2653	-18.5	-18.5	0.49 (1)	10.00				
M-L	0 / 1532	-18.5	-18.5	0.33 (1)	10.00				
L-K	0 / 0	-18.5	-18.5	0.14 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.16")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.29")

CS1: TC=0.78/1.00 (D-E:1), BC=0.49/1.00 (O-Q:1).
 WB=0.55/1.00 (G-M:1), SS1=0.27/1.00 (O-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 .618 .354 .1667 .788 .1987 .1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.90 (B) (INPUT = 0.90)
 JSI METAL=0.85 (N) (INPUT = 1.00)

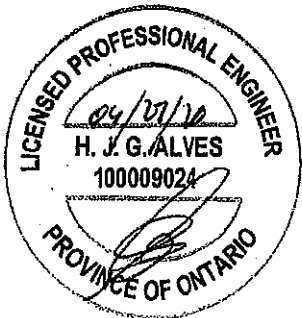

JOB NAME 408151	TRUSS NAME T23	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

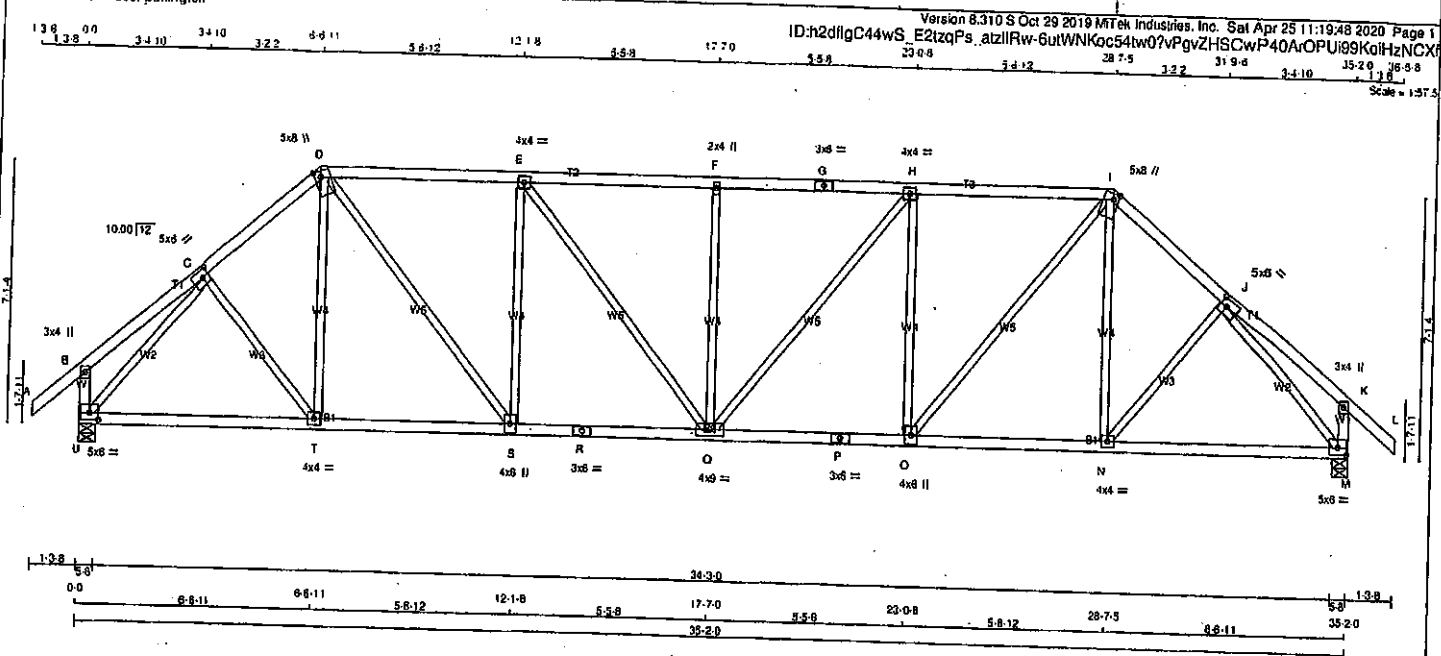

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	LUMBER
A - D	2x4	DRY No.2
E - H	2x4	DRY No.2
I - L	2x4	DRY No.2
M - P	2x4	DRY No.2
Q - R	2x4	DRY No.2
S - T	2x4	DRY No.2
U - V	2x4	DRY No.2
W - X	2x4	DRY No.2
Y - Z	2x4	DRY No.2
ALL WEBS	2x3	DRY No.2
EXCEPT		

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW+1	MT20	5.0	6.0	2.50	2.25
D	TTWV+m	MT20	5.0	8.0	2.00	1.75
E	TMVW+1	MT20	4.0	4.0		
F	TMVW+1	MT20	2.0	4.0		
G	TS+1	MT20	3.0	8.0		
H	TMVW+1	MT20	4.0	4.0		
I	TTWV+m	MT20	5.0	8.0	2.00	1.75
J	TMVW+1	MT20	5.0	8.0	2.50	2.25
K	TMV+p	MT20	3.0	4.0		
L	BMVW+1	MT20	5.0	8.0	2.25	3.00
M	BMVW+1	MT20	4.0	4.0		
N	BMVW+1	MT20	4.0	4.0		
O	BMVW+1	MT20	4.0	4.0		
P	BS+1	MT20	3.0	4.0		
Q	BMVW+1	MT20	4.0	4.0		
R	BS+1	MT20	3.0	4.0		
S	BMVW+1	MT20	4.0	4.0		
T	BMVW+1	MT20	4.0	4.0		
U	BMVW+1	MT20	5.0	8.0	2.25	3.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT 2068	DOWN 2068	0	5-8
U	HORZ 0	HORZ 0	0	5-8
M	VERT 2068	DOWN 2068	0	5-8

UNFACTORED REACTIONS

	1ST LOOSE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERMLIVE WIND DEAD SOIL
U	1458	971 / 0 0 / 0 0 / 0 488 / 0 0 / 0
M	1458	971 / 0 0 / 0 0 / 0 488 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.77 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1	MAX. FACTORED (PLF)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED (LC)
FR-TO					FR-TO		
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00	C-T	0 / 186	0.04 (1)
B-C	0 / 19	-91.8	-91.8 0.14 (1)	10.00	T-D	0 / 76	0.03 (4)
C-D	-2023 / 0	-91.8	-91.8 0.20 (1)	4.59	D-S	0 / 1220	0.27 (1)
D-E	-2308 / 0	-91.8	-91.8 0.55 (1)	3.94	S-E	-850 / 0	0.74 (1)
E-F	-2534 / 0	-91.8	-91.8 0.57 (1)	3.77	E-Q	0 / 361	0.08 (1)
F-G	-2534 / 0	-91.8	-91.8 0.57 (1)	3.77	Q-F	-461 / 0	0.40 (1)
G-H	-2534 / 0	-91.8	-91.8 0.57 (1)	3.77	H-Q	0 / 361	0.08 (1)
H-I	-2308 / 0	-91.8	-91.8 0.55 (1)	3.94	I-H	-850 / 0	0.74 (1)
I-J	-2023 / 0	-91.8	-91.8 0.20 (1)	4.59	Q-I	0 / 1220	0.27 (1)
J-K	0 / 19	-91.8	-91.8 0.14 (1)	10.00	N-I	0 / 76	0.03 (4)
K-L	0 / 41	-91.8	-91.8 0.13 (1)	10.00	N-J	0 / 156	0.04 (1)
L-M	-246 / 0	0.0	0.0 0.03 (1)	7.81	U-C	-2277 / 0	0.98 (1)
M-K	-246 / 0	0.0	0.0 0.03 (1)	7.81	J-M	-2277 / 0	0.98 (1)
U-T	0 / 1433	-18.5	-18.5 0.33 (1)	10.00			
T-S	0 / 1535	-18.5	-18.5 0.35 (1)	10.00			
S-R	0 / 2308	-18.5	-18.5 0.42 (1)	10.00			
R-Q	0 / 2308	-18.5	-18.5 0.42 (1)	10.00			
Q-P	0 / 2308	-18.5	-18.5 0.42 (1)	10.00			
P-O	0 / 2308	-18.5	-18.5 0.42 (1)	10.00			
O-N	0 / 1535	-18.5	-18.5 0.35 (1)	10.00			
N-M	0 / 1433	-18.5	-18.5 0.33 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")

CALCULATED VERT. DEFL. (LL) = L/999 (0.13")

ALLOWABLE DEFL. (TL) = L/360 (1.17")

CALCULATED VERT. DEFL. (TL) = L/999 (0.23")

CSI: TC=0.57/1.00 (E-F:1), BC=0.42/1.00 (D-Q:1), WB=0.98/1.00 (J-M:1), SS=0.24/1.00 (O-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1887	788	1987

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP = 0.89 (1) (INPUT = 0.90)

JSI METAL = 0.72 (1) (INPUT = 1.00)

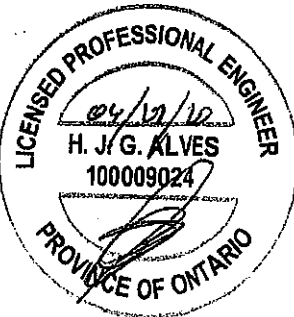

Structural component only
DWG# T-2007085


JOB NAME 408151	TRUSS NAME T24	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:19:49 2020 Page 1	
ID:h2dlfC44wS E2zqPs alzlRw-a4RuagpEsO?ne9UbDd4W_QTXEPW57sssNp3MEjzNCX6				Scale = 1:57.5	

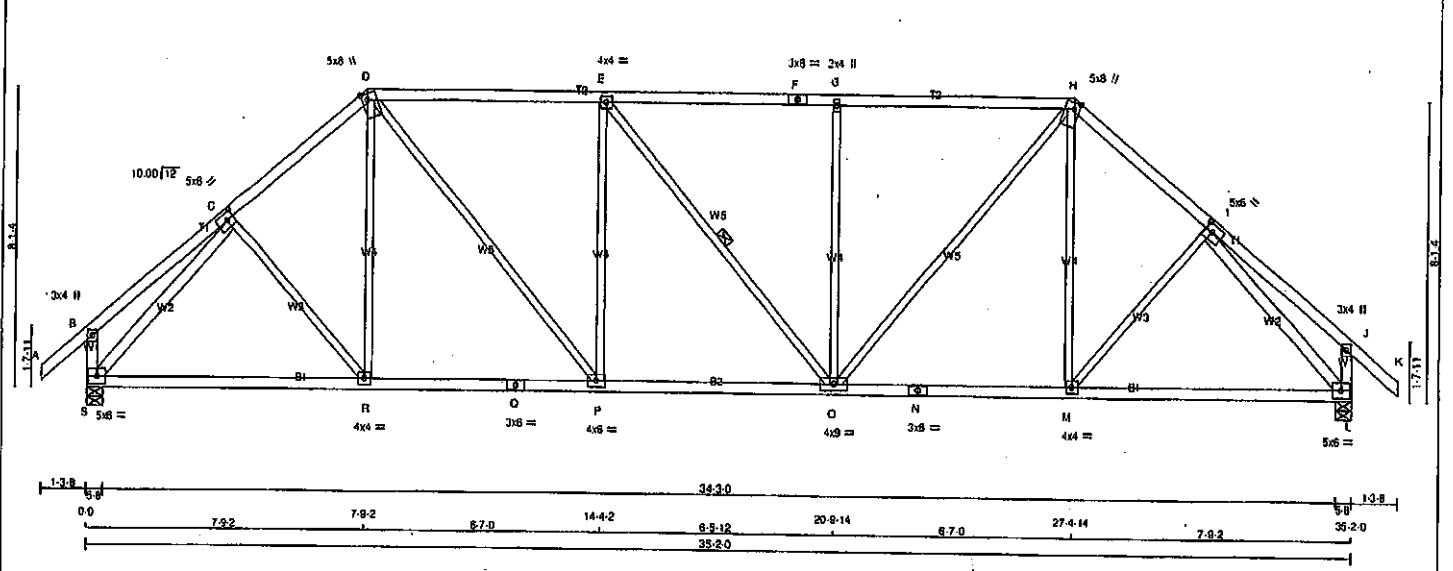

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER DESCR.
A - D 2x4 DRY No.2 SPF
D - F 2x4 DRY No.2 SPF
F - H 2x4 DRY No.2 SPF
H - K 2x4 DRY No.2 SPF
S - B 2x4 DRY No.2 SPF
L - J 2x4 DRY No.2 SPF
S - Q 2x4 DRY No.2 SPF
Q - N 2x4 DRY No.2 SPF
N - L 2x4 DRY No.2 SPF
ALL WEBS 2x3 DRY No.2 SPF
EXCEPT
S - C 2x4 DRY No.2 SPF
I - L 2x4 DRY No.2 SPF
DRY: SEASONED LUMBER.

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE PLATES				
B TMV-p MT20	3.0	4.0		
C TMW-w MT20	5.0	8.0	2.50	2.50
D TTWW-am MT20	5.0	8.0	2.00	1.75
E TMW-w MT20	4.0	4.0		
F TS-I MT20	3.0	6.0		
G TMW-w MT20	2.0	4.0		
H TTWW-am MT20	5.0	8.0	2.00	1.75
I TMW-w MT20	5.0	6.0	2.50	2.50
J TMV-p MT20	3.0	4.0		
L BMW-w MT20	5.0	8.0		
M BMW-w MT20	4.0	4.0		
N BS-I MT20	3.0	6.0		
O BMW-w MT20	4.0	4.0		
P BMW-w MT20	4.0	6.0		
Q BS-I MT20	3.0	6.0		
R BMW-w MT20	4.0	4.0		
S BMW-w MT20	5.0	6.0		

CHORDS	MAX. FACTORED FORCE (LBS)	VERT. LOAD (LBS)	LOI (LBS)	MAX. CSI (LBS)	UNBRAC LENGTH	FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LBS)
A-B	0/41	-91.8	-91.8	0.13 (1)	10.00	C-R	0/64	0.02 (4)	
B-C	0/28	-91.8	-91.8	0.21 (1)	10.00	R-D	0/126	0.04 (4)	
C-D	-2006/0	-91.8	-91.8	0.29 (1)	4.50	D-P	0/998	0.22 (1)	
D-E	-2183/0	-91.8	-91.8	0.73 (1)	3.81	P-E	-650/0	0.82 (1)	
E-F	-2182/0	-91.8	-91.8	0.73 (1)	3.81	E-O	-2/0	0.00 (1)	
F-G	-2182/0	-91.8	-91.8	0.73 (1)	3.81	O-G	-649/0	0.82 (1)	
G-H	-2182/0	-91.8	-91.8	0.73 (1)	3.81	C-H	0/996	0.22 (1)	
H-I	-2006/0	-91.8	-91.8	0.29 (1)	4.50	M-H	0/126	0.04 (4)	
I-J	0/28	-91.8	-91.8	0.21 (1)	10.00	M-I	0/64	0.02 (4)	
J-K	0/41	-91.8	-91.8	0.13 (1)	10.00	S-C	-2291/0	0.87 (1)	
S-B	-264/0	0.0	0.0	0.03 (1)	7.81	I-L	-2291/0	0.87 (1)	
L-J	-264/0	0.0	0.0	0.03 (1)	7.81				
S-R	0/1487	-18.5	-18.5	0.38 (1)	10.00				
R-Q	0/1519	-18.5	-18.5	0.39 (1)	10.00				
Q-P	0/1519	-18.5	-18.5	0.39 (1)	10.00				
P-O	0/2163	-18.5	-18.5	0.42 (1)	10.00				
O-N	0/1519	-18.5	-18.5	0.38 (1)	10.00				
N-M	0/1519	-18.5	-18.5	0.39 (1)	10.00				
M-L	0/1487	-18.5	-18.5	0.38 (1)	10.00				

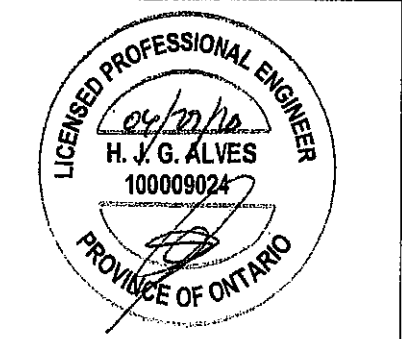

Structural component only
DWG# T-2007086

UNFACTORED REACTIONS
1ST CASE MAX/MIN COMPONENT REACTIONS
JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL
S 1458 971/0 0/0 0/0 0/0 488/0 0/0
L 1458 971/0 0/0 0/0 0/0 488/0 0/0

FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	DOWN	HORIZ	UPLIFT
S 2088	0	2088	0
L 2088	0	2088	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L
BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.81 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.
1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-O.
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)


CHORDS	MAX. FACTORED FORCE (LBS)	VERT. LOAD (LBS)	LOI (LBS)	MAX. CSI (LBS)	UNBRAC LENGTH	FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LBS)
A-B	0/41	-91.8	-91.8	0.13 (1)	10.00	C-R	0/64	0.02 (4)	
B-C	0/28	-91.8	-91.8	0.21 (1)	10.00	R-D	0/126	0.04 (4)	
C-D	-2006/0	-91.8	-91.8	0.29 (1)	4.50	D-P	0/998	0.22 (1)	
D-E	-2183/0	-91.8	-91.8	0.73 (1)	3.81	P-E	-650/0	0.82 (1)	
E-F	-2182/0	-91.8	-91.8	0.73 (1)	3.81	E-O	-2/0	0.00 (1)	
F-G	-2182/0	-91.8	-91.8	0.73 (1)	3.81	O-G	-649/0	0.82 (1)	
G-H	-2182/0	-91.8	-91.8	0.73 (1)	3.81	C-H	0/996	0.22 (1)	
H-I	-2006/0	-91.8	-91.8	0.29 (1)	4.50	M-H	0/126	0.04 (4)	
I-J	0/28	-91.8	-91.8	0.21 (1)	10.00	M-I	0/64	0.02 (4)	
J-K	0/41	-91.8	-91.8	0.13 (1)	10.00	S-C	-2291/0	0.87 (1)	
S-B	-264/0	0.0	0.0	0.03 (1)	7.81	I-L	-2291/0	0.87 (1)	
L-J	-264/0	0.0	0.0	0.03 (1)	7.81				
S-R	0/1487	-18.5	-18.5	0.38 (1)	10.00				
R-Q	0/1519	-18.5	-18.5	0.39 (1)	10.00				
Q-P	0/1519	-18.5	-18.5	0.39 (1)	10.00				
P-O	0/2163	-18.5	-18.5	0.42 (1)	10.00				
O-N	0/1519	-18.5	-18.5	0.38 (1)	10.00				
N-M	0/1519	-18.5	-18.5	0.39 (1)	10.00				
M-L	0/1487	-18.5	-18.5	0.38 (1)	10.00				

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN/C
LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015
THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABO 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014
(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD
ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.21")
CSI: TC=0.73/1.00 (D-E:1), BC=0.42/1.00 (O-P:1), WB=0.87/1.00 (I-L:1), SS=0.28/1.00 (D-E:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10
COMPANION LIVE LOAD FACTOR = 1.00
AUTOSOLVE HEELS OFF
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1887 1658
PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP=0.87 (I) (INPUT = 0.90)
JSI METAL=0.56 (I) (INPUT = 1.00)

TOTAL WEIGHT = 2 X 163 = 326 lb (M)

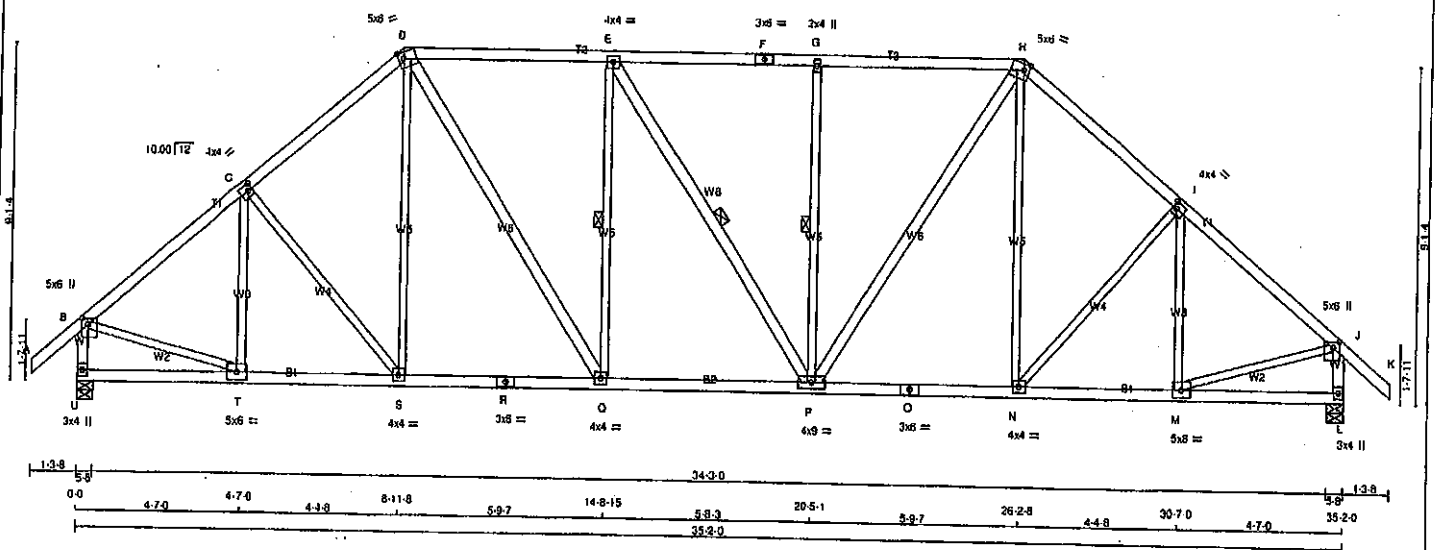

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - K	2x4	DRY	No.2	SPF
U - B	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
U - R	2x4	DRY	No.2	SPF
R - O	2x4	DRY	No.2	SPF
O - L	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
D - Q	2x4	DRY	No.2	SPF
E - P	2x4	DRY	No.2	SPF
P - H	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	8.0	2.00	2.00
C	TMVW-1	MT20	4.0	4.0	2.00	1.25
D	TTVW-m	MT20	5.0	6.0	2.00	1.75
E	TMVW-1	MT20	4.0	4.0		
F	TS-1	MT20	3.0	6.0		
G	TMVW-w	MT20	2.0	4.0		
H	TTVW-m	MT20	5.0	8.0	2.00	1.75
I	TMVW-1	MT20	4.0	4.0	2.00	1.25
J	TMVW+p	MT20	5.0	6.0	2.00	2.00
L	BMV1+p	MT20	3.0	4.0		
M	BMVW-1	MT20	5.0	6.0		
N, Q, S						
N	BMVW-1	MT20	4.0	4.0		
O	BS-1	MT20	3.0	6.0		
P	BMVW-1	MT20	4.0	4.0		
R	BS-1	MT20	3.0	6.0		
T	BMVW-1	MT20	5.0	6.0		
U	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECRD BRG
JT	VERT	DOWN	UPLIFT	IN-SX
U	2068 0	2068 0	0	5-8
L	2068 0	2068 0	0	5-8

UNFACTORED REACTIONS

	1ST CASE	MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
U	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.44 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-Q, E-P, G-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 41	-91.8 -91.8	0.13 (1)	10.00	T-C	-357 / 0	0.16 (1)
B-C	-1994 / 0	-91.8 -91.8	0.30 (1)	4.53	C-S	-121 / 0	0.10 (1)
C-D	-1857 / 0	-91.8 -91.8	0.29 (1)	4.57	S-D	0 / 188	0.05 (4)
D-E	-1823 / 0	-91.8 -91.8	0.40 (1)	4.44	D-Q	0 / 810	0.13 (1)
E-F	-1821 / 0	-91.8 -91.8	0.37 (1)	4.49	Q-E	-568 / 0	0.31 (1)
F-G	-1921 / 0	-91.8 -91.8	0.37 (1)	4.49	E-P	-3 / 0	0.00 (1)
G-H	-1921 / 0	-91.8 -91.8	0.40 (1)	4.45	P-G	-568 / 0	0.31 (1)
H-I	-1957 / 0	-91.8 -91.8	0.29 (1)	4.57	P-H	0 / 807	0.13 (1)
I-J	-1984 / 0	-91.8 -91.8	0.30 (1)	4.53	N-H	0 / 169	0.05 (4)
J-K	0 / 41	-91.8 -91.8	0.13 (1)	10.00	N-I	-121 / 0	0.10 (1)
U-B	-2028 / 0	0.0 0.0	0.22 (1)	5.94	M-I	-358 / 0	0.16 (1)
L-J	-2028 / 0	0.0 0.0	0.22 (1)	5.94	B-T	0 / 1617	0.39 (1)
U-T	0 / 0	-18.5 -18.5	0.08 (4)	10.00	M-J	0 / 1617	0.38 (1)
T-S	0 / 1555	-18.5 -18.5	0.30 (1)	10.00			
S-R	0 / 1477	-18.5 -18.5	0.30 (1)	10.00			
R-Q	0 / 1477	-18.5 -18.5	0.30 (1)	10.00			
Q-P	0 / 1923	-18.5 -18.5	0.38 (1)	10.00			
P-O	0 / 1478	-18.5 -18.5	0.30 (1)	10.00			
O-N	0 / 1478	-18.5 -18.5	0.30 (1)	10.00			
N-M	0 / 1555	-18.5 -18.5	0.31 (1)	10.00			
M-L	0 / 0	-18.5 -18.5	0.08 (4)	10.00			

TOTAL WEIGHT = 2 X 182 = 363 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCO 2010, NBCO 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBCO 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/989 (0.08')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/998 (0.16')

CSK TC=0.40/1.00 (D-E:1), BC=0.38/1.00 (P-Q:1), WB=0.38/1.00 (B-T:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE	GRP(DRY)	SHEAR (PSI)	SECTION (PL)
MT20	818	354	1687 788 1987 1050


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (B) (INPUT = 0.90)
JSI METAL = 0.50 (C) (INPUT = 1.00)



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408151	T26	4	1	TRUSS DESC.		

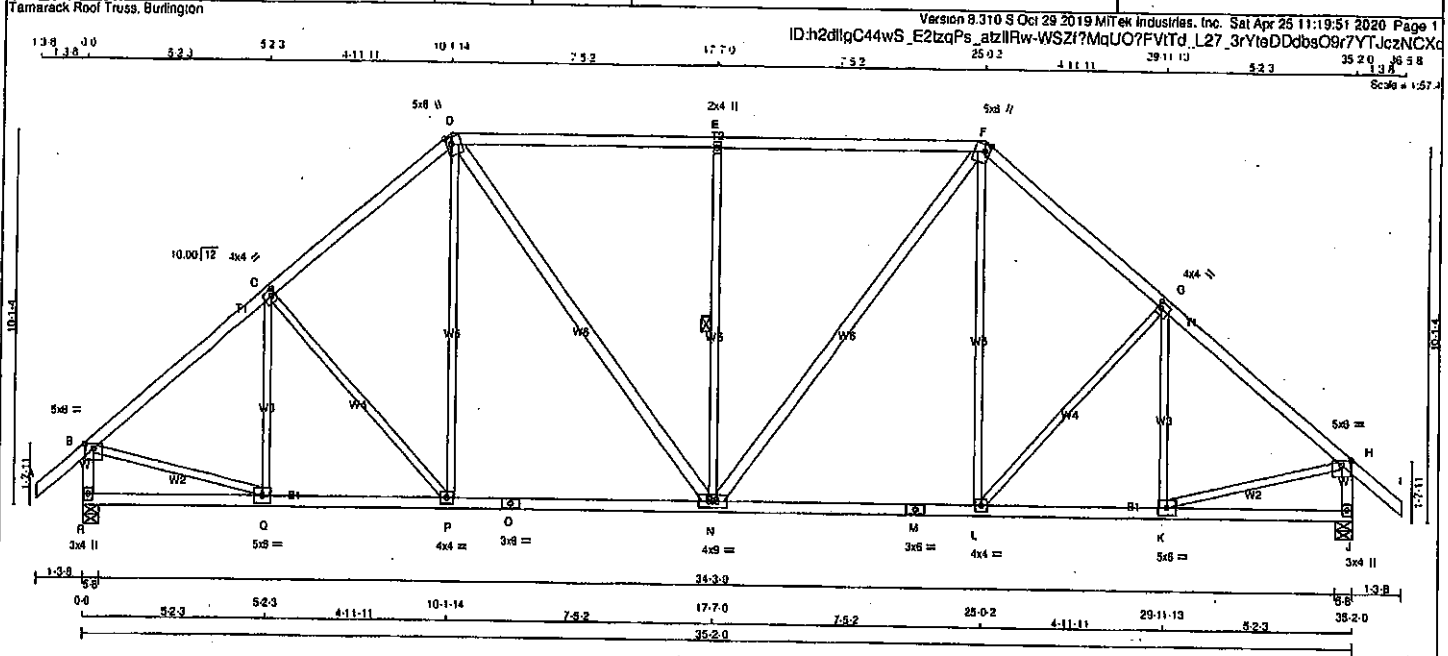

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - B	2x4	DRY	No.2
B - H	2x4	DRY	No.2
H - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	6.0	1.50 3.00
C	TMVW-l	MT20	4.0	4.0	2.00 1.25
D	TTWW-m	MT20	5.0	6.0	2.25 1.50
E	TMVW-w	MT20	2.0	4.0	
F	TTWW-m	MT20	5.0	6.0	2.25 1.50
G	TMVW-l	MT20	4.0	4.0	2.00 1.25
H	TMVW-p	MT20	5.0	6.0	1.50 3.00
J	BMV1-p	MT20	3.0	4.0	
K	BMVW-l	MT20	5.0	6.0	
L	BMVW-l	MT20	4.0	4.0	
M	BS-l	MT20	3.0	6.0	
N	BMVWW-l	MT20	4.0	9.0	
O	BS-l	MT20	3.0	6.0	
P	BMVW-l	MT20	4.0	4.0	
Q	BMVW-l	MT20	5.0	6.0	
R	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
R	2068	0	2068	0	0
J	2068	0	2068	0	0

UNFACTORED REACTIONS					
1ST LCASE	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
JT	1458	971.0	0.0	0.0	0.0
R	1458	971.0	0.0	0.0	0.0
J	1458	971.0	0.0	0.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.88 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0.0	-91.8	-91.8	0.13 (1)	10.00	0.0	0.17 (1)
B-C	-2021.0	-91.8	-91.8	0.39 (1)	4.41	-217.0	0.25 (1)
C-D	-1808.0	-91.8	-91.8	0.37 (1)	4.52	0.0	0.08 (1)
D-E	-1809.0	-91.8	-91.8	0.74 (1)	3.98	0.0	0.10 (1)
E-F	-1808.0	-91.8	-91.8	0.74 (1)	3.98	0.0	0.10 (1)
F-G	-1808.0	-91.8	-91.8	0.37 (1)	4.52	0.0	0.10 (1)
G-H	-2021.0	-91.8	-91.8	0.39 (1)	4.41	0.0	0.08 (1)
H-I	0.0	-91.8	-91.8	0.13 (1)	10.00	0.0	0.17 (1)
I-J	-2024.0	0.0	0.0	0.22 (1)	5.94	-217.0	0.25 (1)
J-K	-2024.0	0.0	0.0	0.22 (1)	5.94	0.0	0.17 (1)
K-L	0.0	-18.5	-18.5	0.10 (4)	10.00	0.0	0.17 (1)
L-M	0.0	-18.5	-18.5	0.34 (1)	10.00	0.0	0.17 (1)
M-N	0.0	-18.5	-18.5	0.35 (1)	10.00	0.0	0.17 (1)
N-O	0.0	-18.5	-18.5	0.35 (1)	10.00	0.0	0.17 (1)
O-P	0.0	-18.5	-18.5	0.35 (1)	10.00	0.0	0.17 (1)
P-Q	0.0	-18.5	-18.5	0.34 (1)	10.00	0.0	0.17 (1)
Q-R	0.0	-18.5	-18.5	0.10 (4)	10.00	0.0	0.17 (1)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GIC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.17")

CSI: TC=0.74/1.00 (D-E:1), BC=0.35/1.00 (L-N:1), WB=0.58/1.00 (E-N:1), SS=0.33/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 L.S BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (B) (INPUT = 0.90)
JSI METAL= 0.48 (M) (INPUT = 1.00)

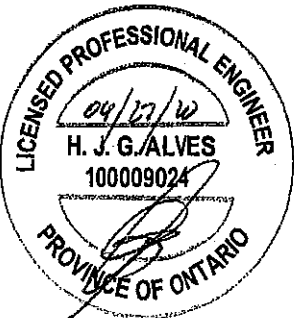

Structural component only
DWG# T-2007088


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408151	T27	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

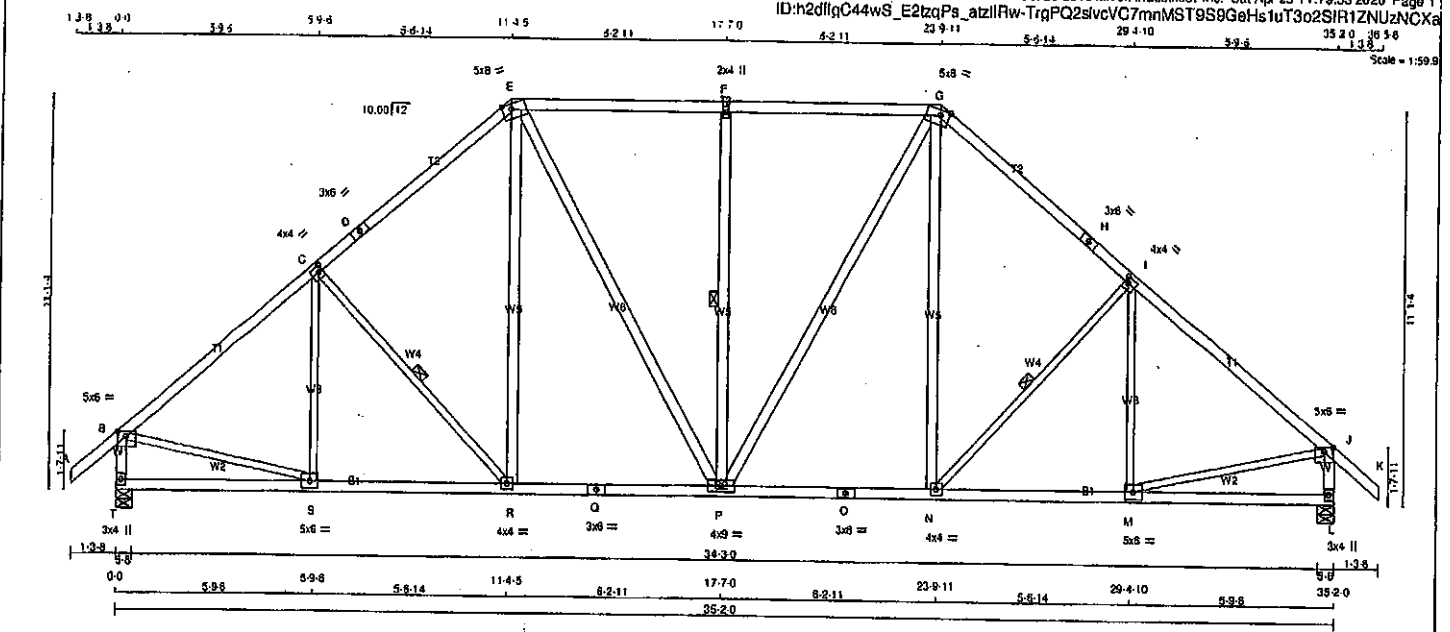

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
T - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
T - Q	2x4	DRY	No.2
Q - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x4	DRY	No.2
S - C	2x3	DRY	No.2
C - R	2x3	DRY	No.2
N - I	2x3	DRY	No.2
M - I	2x3	DRY	No.2
B - S	2x3	DRY	No.2
M - J	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	6.0	1.50 3.00
C	TMVW-1	MT20	4.0	4.0	2.00 1.25
D	TS-1	MT20	3.0	6.0	
E	TTWW-m	MT20	5.0	8.0	Edge 3.00
F	TTWW-m	MT20	2.0	4.0	
G	TS-1	MT20	5.0	8.0	Edge 3.00
H	TS-1	MT20	3.0	6.0	
I	TMVW-1	MT20	4.0	4.0	2.00 1.25
J	TMVW-p	MT20	5.0	6.0	1.50 3.00
L	BMV1-p	MT20	3.0	4.0	
M	BMVW-1	MT20	5.0	6.0	
N	BMVW-1	MT20	4.0	4.0	
O	BS-1	MT20	3.0	6.0	
P	BMVW-1	MT20	4.0	4.0	
Q	BS-1	MT20	3.0	6.0	
R	BMVW-1	MT20	4.0	4.0	
S	BMVW-1	MT20	5.0	6.0	
T	BMV1-p	MT20	3.0	4.0	

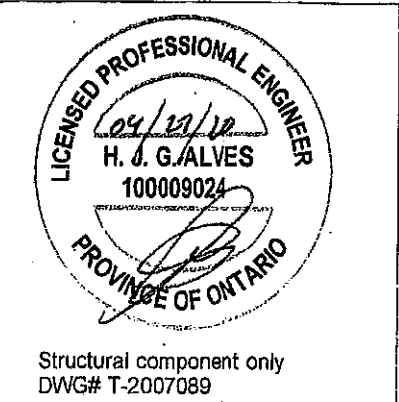

Structural component only
DWG# T-2007089

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED	MAXIMUM FACTORED	INPUT	REQD	
	GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
T	2068	0	2068	0	0
L	2068	0	2068	0	0

UNFACTORED REACTIONS						
1ST CASE	MAX/MIN	COMPONENT	RECTIONS			
JT	COMBINED	SNOW	LIVE	PERM	LIVE	WIND
T	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0
L	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.27 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-R, F-P, H-L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FACTORED	FACTORED	FACTORED	MEMB.	FACTORED	FACTORED	FACTORED
	FORCE	VERT. LOAD	MAX		FORCE	MAX	MAX
(LBS)	(LBS)	(LC)	(LC)	(LBS)	(LBS)	(LC)	(LC)
FR-TO				FR-TO			
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00	S-C	-245 / 10	0.17 (1)
B-C	-2039 / 0	-91.8	-91.8 0.50 (1)	4.27	C-R	-314 / 0	0.15 (1)
C-D	-1844 / 0	-91.8	-91.8 0.46 (1)	4.47	R-E	0 / 338	0.05 (1)
D-E	-1844 / 0	-91.8	-91.8 0.46 (1)	4.47	E-P	0 / 489	0.08 (1)
E-F	-1621 / 0	-91.8	-91.8 0.50 (1)	4.60	P-F	-699 / 0	0.45 (1)
F-G	-1621 / 0	-91.8	-91.8 0.50 (1)	4.60	P-G	0 / 489	0.08 (1)
G-H	-1844 / 0	-91.8	-91.8 0.46 (1)	4.47	N-G	0 / 338	0.05 (1)
H-I	-1844 / 0	-91.8	-91.8 0.46 (1)	4.47	N-I	-314 / 0	0.15 (1)
I-J	-2039 / 0	-91.8	-91.8 0.50 (1)	4.27	M-I	-245 / 10	0.17 (1)
J-K	0 / 41	-91.8	-91.8 0.13 (1)	10.00	B-S	0 / 1637	0.37 (1)
T-B	-2021 / 0	0.0	0.0 0.21 (1)	5.94	M-J	0 / 1637	0.37 (1)
L-J	-2021 / 0	0.0	0.0 0.21 (1)	5.94			
T-S	0 / 0	-18.5	-18.5 0.14 (4)	10.00			
S-R	0 / 1597	-18.5	-18.5 0.33 (1)	10.00			
R-Q	0 / 1387	-18.5	-18.5 0.30 (1)	10.00			
Q-P	0 / 1387	-18.5	-18.5 0.30 (1)	10.00			
P-O	0 / 1387	-18.5	-18.5 0.30 (1)	10.00			
O-N	0 / 1387	-18.5	-18.5 0.30 (1)	10.00			
N-M	0 / 1597	-18.5	-18.5 0.33 (1)	10.00			
M-L	0 / 0	-18.5	-18.5 0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/989 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/989 (0.14")

CSI: TC=0.80/1.00 (E-F:1), BC=0.33/1.00 (M-N:1), WB=0.45/1.00 (F-P:1), SS=0.28/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.89 (J) (INPUT = 0.80)
JSI METAL= 0.47 (O) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408151	T28	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 11:19:54 2020 Page 1
ID:h2dfgC44wS_E2tzqPs_atzMRw-x1EndOIngwd3kwMZ0AghhTAWTQH0oB?bX5n7vxzNCXZ

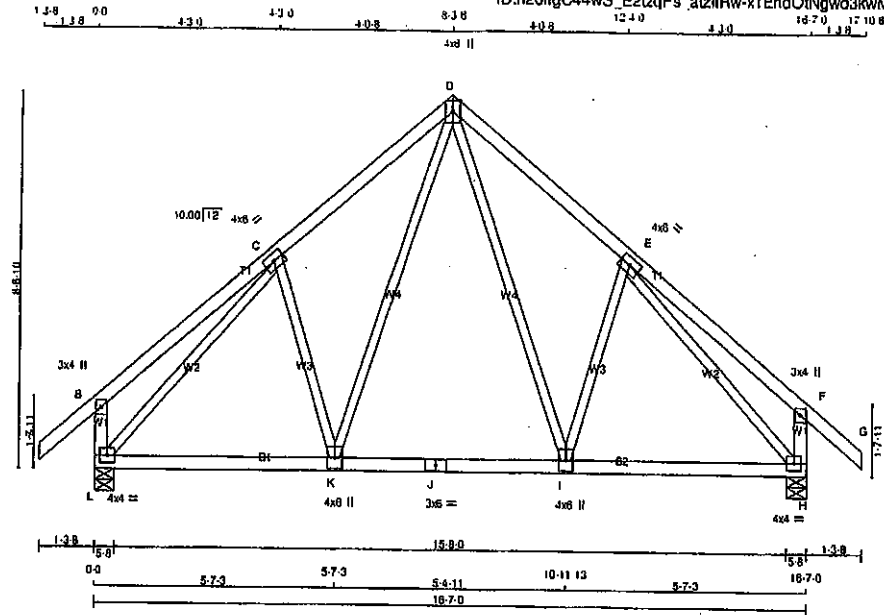

TOTAL WEIGHT = 2 X 82 = 164 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2		
D - G	2x4	DRY	No.2		
L - B	2x4	DRY	No.2		
H - F	2x4	DRY	No.2		
L - J	2x4	DRY	No.2		
J - H	2x4	DRY	No.2		

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (tablets in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-i	MT20	4.0	8.0		
D	TTWW+p	MT20	4.0	8.0		
E	TMWW-i	MT20	4.0	8.0		
F	TMV+p	MT20	3.0	4.0		
H	BMVW-i	MT20	4.0	4.0		
I	BMVW-i	MT20	4.0	8.0		
J	BS-i	MT20	3.0	8.0		
K	BMVW-i	MT20	4.0	8.0		
L	BMVW-i	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
L	1041	0	1041	0	5-8	5-8
H	1041	0	1041	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	734	495 / 0	0 / 0	0 / 0	0 / 0	239 / 0	0 / 0
H	734	495 / 0	0 / 0	0 / 0	0 / 0	239 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	CHORDS			WEBS		
		VERT. LOAD (PLF)	FACTORED VERT. LOAD (LC1)	MAX. CS1 (LC)	MAX. UNBRACED LENGTH	MEMB. FORCE (LBS)	MAX. FACTORED CS1 (LC)
FR-TO							
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	D-I	0 / 339
B-C	0 / 29	-91.8	-91.8	0.28 (1)	10.00	E-E	-222 / 0
C-D	-764 / 0	-91.8	-91.8	0.20 (1)	8.25	K-D	0 / 339
D-E	-764 / 0	-91.8	-91.8	0.20 (1)	8.25	C-K	-222 / 0
E-F	0 / 29	-91.8	-91.8	0.28 (1)	10.00	L-C	-984 / 0
F-G	0 / 41	-91.8	-91.8	0.13 (1)	10.00	E-H	-984 / 0
L-B	-270 / 0	0.0	0.0	0.03 (1)	7.81		
H-F	-270 / 0	0.0	0.0	0.03 (1)	7.81		
L-K	0 / 632	-18.5	-18.5	0.18 (4)	10.00		
K-J	0 / 459	-18.5	-18.5	0.17 (4)	10.00		
J-I	0 / 459	-18.5	-18.5	0.17 (4)	10.00		
I-H	0 / 632	-18.5	-18.5	0.18 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.55")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.55")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.28/1.00 (B-C:1), BC=0.18/1.00 (H-I:4), WB=0.88/1.00 (E-H:1), SSI=0.14/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.78 (C) (INPUT = 0.90)
JSI METAL = 0.28 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007090

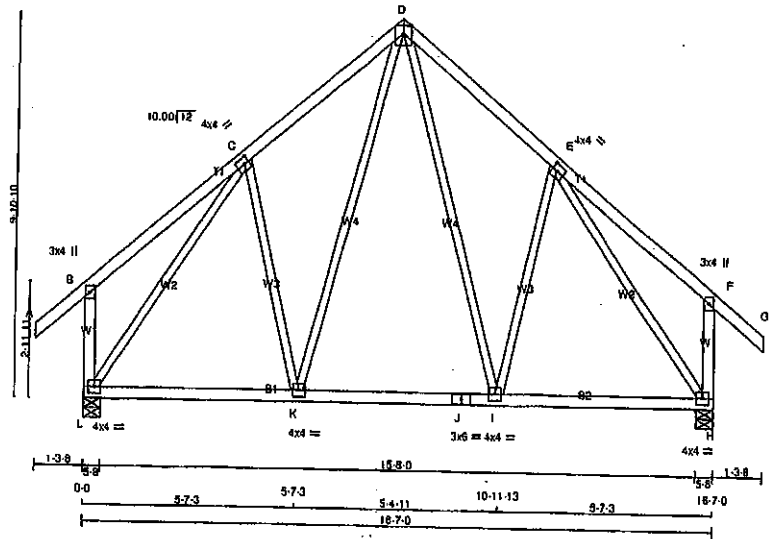

DRY: SEASONED LUMBER.

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

UNFACTORED REACTIONS

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L. H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED CSI (I)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (I)
FR-TO		FROM TO			FR-TO		
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00	D-I	0 / 254	0.08 (1)
B-C	0 / 28	-91.8	-91.8 0.26 (1)	10.00	J-E	-138 / 14	0.10 (1)
C-D	-633 / 0	-91.8	-91.8 0.20 (1)	6.25	K-D	0 / 254	0.08 (1)
D-E	-633 / 0	-91.8	-91.8 0.20 (1)	6.25	C-K	-138 / 14	0.10 (1)
E-F	0 / 28	-91.8	-91.8 0.26 (1)	10.00	L-C	-875 / 0	0.90 (1)
F-G	0 / 41	-91.8	-91.8 0.13 (1)	10.00	E-H	-875 / 0	0.90 (1)
L-B	-276 / 0	0.0	0.0 0.04 (1)	7.81			
H-F	-276 / 0	0.0	0.0 0.04 (1)	7.81			
L-K	0 / 495	-18.5	-18.5 0.17 (4)	10.00			
K-J	0 / 395	-18.5	-18.5 0.16 (4)	10.00			
J-I	0 / 385	-18.5	-18.5 0.16 (4)	10.00			
I-H	0 / 495	-18.5	-18.5 0.17 (4)	10.00			

DESIGN CRITERIA

TOTAL WEIGHT = 91 lb
(M)(F)

SPECIFIED LOADS:

TOP CH.	LL =	25.8	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.55")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL)= L/380 (0.55")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.26/1.00 (E-F:1), BC=0.17/1.00 (K-L:4),
WB=0.90/1.00 (E-H:1), SSI=0.14/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)		SHEAR		SECTION
	(PSI)		(PLI)		(PLI)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	818	354	1667	788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (E) (INPUT = 0.90)
JSI METAL= 0.34 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007091

JOB NAME 408151	TRUSS NAME T30	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTak Industries, Inc. Sat Apr 25 11:19:58 2020 Page 1

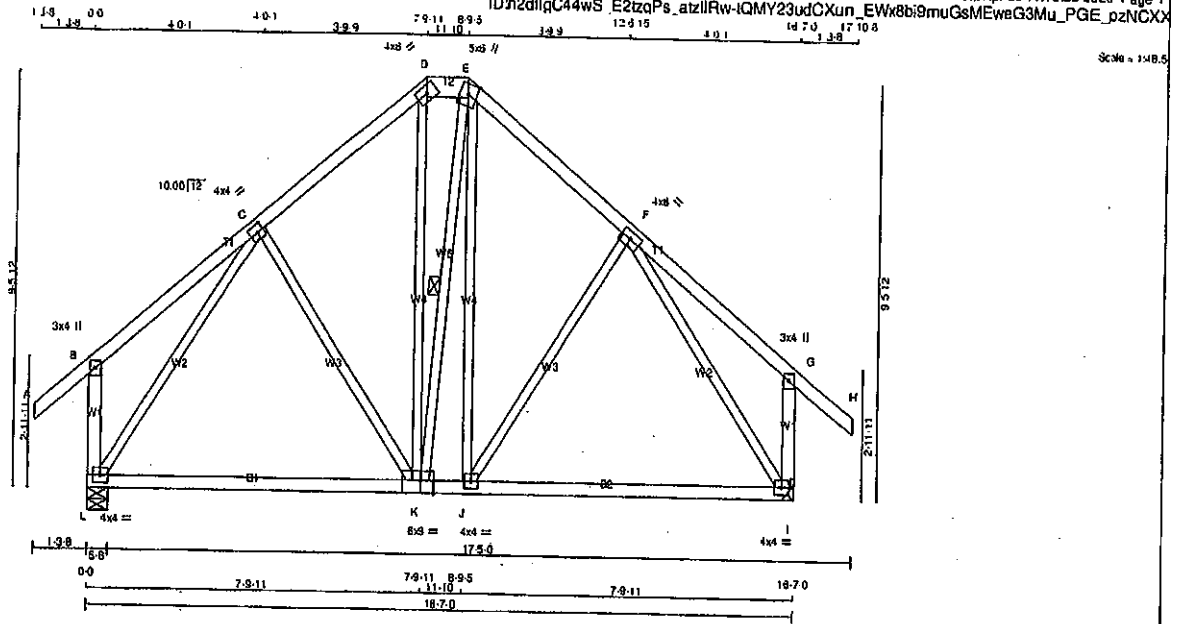

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - E	2x6	DRY	No.2	SPF		
E - H	2x4	DRY	No.2	SPF		
L - B	2x4	DRY	No.2	SPF		
I - G	2x4	DRY	No.2	SPF		
L - K	2x4	DRY	No.2	SPF		
K - I	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-1	MT20	4.0	4.0	2.00	1.75
D	TTW-h	MT20	4.0	8.0		
E	TTWW+m	MT20	5.0	6.0	Edge	
F	TMWW-1	MT20	4.0	8.0		
G	TMV+p	MT20	3.0	4.0		
I	BMVW-1	MT20	4.0	4.0		
J	BMWW-1	MT20	4.0	4.0		
K	BSWW-1	MT20	6.0	9.0	Edge	3.75
L	BMVW-1	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	HORZ	DOWN	HORZ
L	1041	0	0
I	1041	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3.8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	734	495 / 0	0 / 0	0 / 0	0 / 0	239 / 0	0 / 0
I	734	495 / 0	0 / 0	0 / 0	0 / 0	239 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO									
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	C-K	-98 / 9	0.09 (1)	
B-C	0 / 27	-91.8	-91.8	0.23 (1)	10.00	K-D	0 / 164	0.04 (1)	
C-D	-566 / 0	-91.8	-91.8	0.18 (1)	8.25	K-E	-109 / 0	0.07 (4)	
D-E	-414 / 0	-91.8	-91.8	0.01 (1)	8.25	J-F	0 / 288	0.07 (4)	
E-F	-582 / 0	-91.8	-91.8	0.18 (1)	8.25	J-G	-93 / 15	0.09 (1)	
F-G	0 / 27	-91.8	-91.8	0.23 (1)	10.00	L-C	-846 / 0	0.78 (1)	
G-H	0 / 41	-91.8	-91.8	0.13 (1)	10.00	F-I	-662 / 0	0.79 (1)	
L-B	-265 / 0	0.0	0.0	0.04 (1)	7.81				
I-G	-265 / 0	0.0	0.0	0.04 (1)	7.81				
L-K	0 / 468	-18.5	-18.5	0.38 (4)	10.00				
K-J	0 / 424	-18.5	-18.5	0.30 (4)	10.00				
J-I	0 / 477	-18.5	-18.5	0.30 (4)	10.00				

TOTAL WEIGHT = 97 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
DL	=	6.0	PSF	
BOT CH.	LL	=	0.0	PSF
DL	=	7.4	PSF	
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.55")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.01")
ALLOWABLE DEFL. (TL) = $L/360$ (0.55")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.17")

CSI: TC=0.23/1.00 (B-C:1), BC=0.38/1.00 (K-L:4), WB=0.79/1.00 (F-I:1), SI=0.14/1.00 (J-K:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1887

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (C) (INPUT = 0.90)
JSI METAL= 0.31 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007092

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408151	T31	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:19:57 2020 Page 1
ID:h2dfgC44wS_E2lqPs_atzHfRw-LcwwGPvFzr0ebO58hDOJ5o2BelD?ZeID3?nWFzNCXW

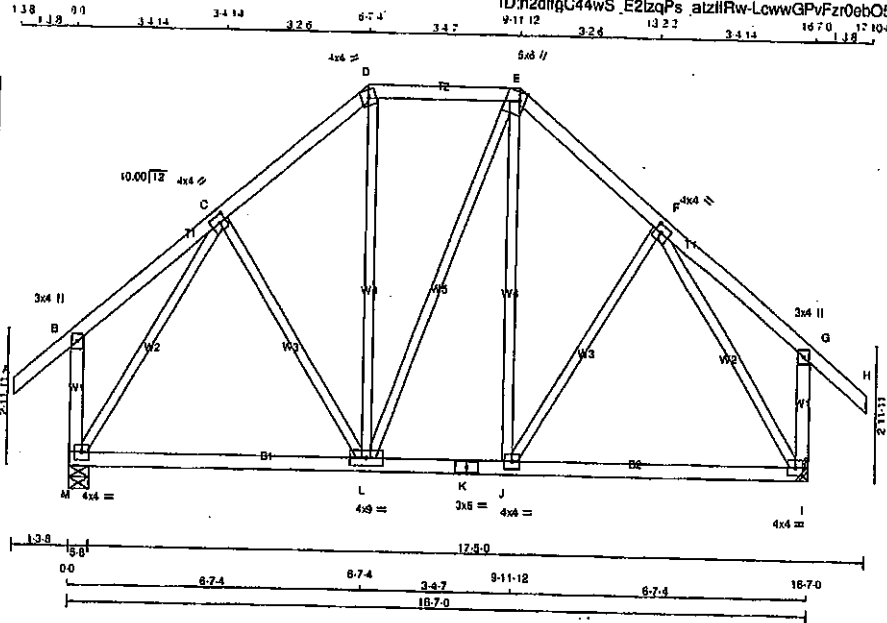

Scale = 1/4\"/>

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
E - H	2x4	DRY	No.2	SPF	
M - B	2x4	DRY	No.2	SPF	
I - G	2x4	DRY	No.2	SPF	
M - K	2x4	DRY	No.2	SPF	
K - I	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table to 1/4 inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-1	MT20	4.0	4.0	2.00	1.75
D	TTW-m	MT20	4.0	4.0		
E	TTWV+m	MT20	5.0	6.0	2.25	1.50
F	TMVW-1	MT20	4.0	4.0	2.00	1.75
G	TMV+p	MT20	3.0	4.0		
I	BMVW-1	MT20	4.0	4.0		
J	BMVW-1	MT20	4.0	4.0		
K	BS-1	MT20	3.0	6.0		
L	BMVW-1	MT20	4.0	9.0		
M	BMVW-1	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
M	1041	0	1041	0
I	1041	0	1041	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3.8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS	DEAD	SOIL
M	734	495/0	0/0	0/0	0/0
I	734	495/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED	FORCE	VERT. LOAD	LCI	MAX	MAX.	WEBS	MEMB.	MAX. FACTORED	FORCE	MAX
			(LBS)			(PLF)	CS1 (LC)				(LBS)	CS1 (LC)
FR-TO												
A-B	0/41								C-L	-10/34		0.01 (4)
B-C	0/22								L-D	0/110		0.03 (4)
C-D	-613/0								L-E	0/0		0.00 (1)
D-E	-403/0								J-E	0/109		0.03 (4)
E-F	-612/0								J-F	-11/34		0.01 (4)
F-G	0/22								M-C	-873/0		0.60 (1)
G-H	0/41								F-I	-873/0		0.60 (1)
H-I	-245/0											
I-G	-245/0											
M-L	0/457											
L-K	0/453											
K-J	0/453											
J-I	0/457											

TOTAL WEIGHT = 92 b
[M/F]

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPC 2011, TPC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.55")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.55")
CALCULATED VERT. DEFL.(TL) = L/999 (0.07")

CS1: TC=0.18/1.00 (F-G:1), BC=0.21/1.00 (H-J:4),
WB=0.60/1.00 (C-M:1), SS=0.12/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX	MIN	MAX
MT20	616	354
	1687	798
	1687	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (C) (INPUT = 0.90)
JSI METAL = 0.31 (C) (INPUT = 1.00)

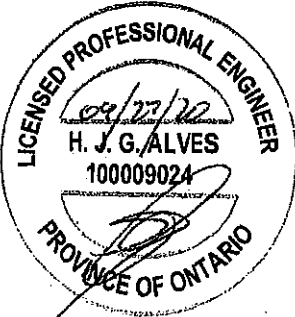


Structural component only
DWG# T-2007093

JOB NAME 408151	TRUSS NAME T32	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:19:58 2020 Page 1
ID:h2dflgC44wS_E2tzqPs_atzllRw-ppUlltwk98VDYgKf0drJL8l2l0k80BSjIK2izNCXV

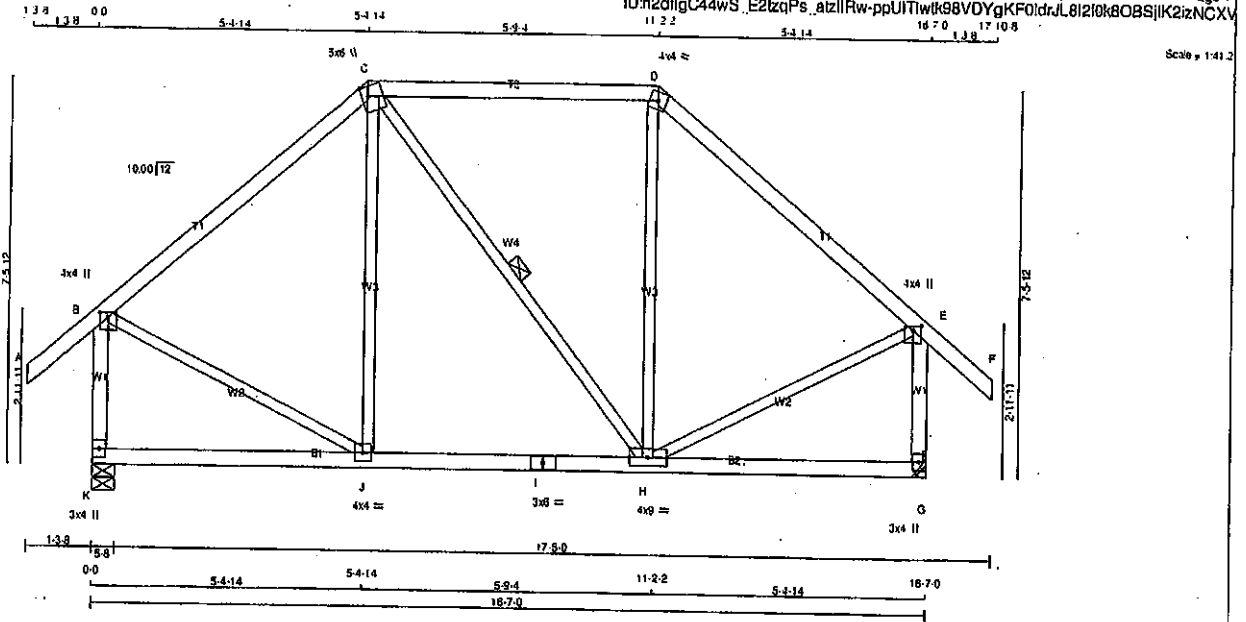

Scale = 1/4" = 1'-0"

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
K - B	2x4	DRY	No.2	SPF	
G - E	2x4	DRY	No.2	SPF	
K - I	2x4	DRY	No.2	SPF	
I - G	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTWV+m	MT20	5.0	6.0	2.25	1.50
D	TTW-m	MT20	4.0	4.0		
E	TMVW+p	MT20	4.0	4.0	1.00	2.00
G	BMV1+p	MT20	3.0	4.0		
H	BMVWW-1	MT20	4.0	9.0		
I	BS-1	MT20	3.0	6.0		
J	BMVWW-1	MT20	4.0	4.0		
K	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
K	1041	0	1041	0	5-8
G	1041	0	1041	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
K	734	495/0	0/0	0/0	0/0	239/0	0/0
G	734	495/0	0/0	0/0	0/0	239/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-H.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	MAX. (PLF)	MEMB.	FORCE (LBS)	MAX. (PLF)	MAX. (LBS)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0/41	-91.8	-91.8 0.13 (1)	10.00	J-C	-115/46	0.12 (1)
B-C	-619/0	-91.8	-91.8 0.35 (1)	6.25	C-H	0/0	0.00 (1)
C-D	-473/0	-91.8	-91.8 0.39 (1)	6.25	H-D	-115/46	0.12 (1)
D-E	-619/0	-91.8	-91.8 0.35 (1)	6.25	B-J	0/528	0.12 (1)
E-F	0/41	-91.8	-91.8 0.13 (1)	10.00	H-E	0/528	0.12 (1)
K-B	-1000/0	0.0	0.0 0.16 (1)	7.81			
G-E	-1000/0	0.0	0.0 0.16 (1)	7.81			
K-J	0/0	-18.5	-18.5 0.13 (4)	10.00			
J-I	0/473	-18.5	-18.5 0.17 (4)	10.00			
I-H	0/473	-18.5	-18.5 0.17 (4)	10.00			
H-G	0/0	-18.5	-18.5 0.13 (4)	10.00			

TOTAL WEIGHT = 79 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.55")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.55")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.39/1.00 (C-D:1), BC=0.17/1.00 (H-J:4), WB=0.12/1.00 (B-J:1), SS=0.21/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1987 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.82 (B) (INPUT = 0.80)
JSI METAL = 0.23 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007094

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408151	G33	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

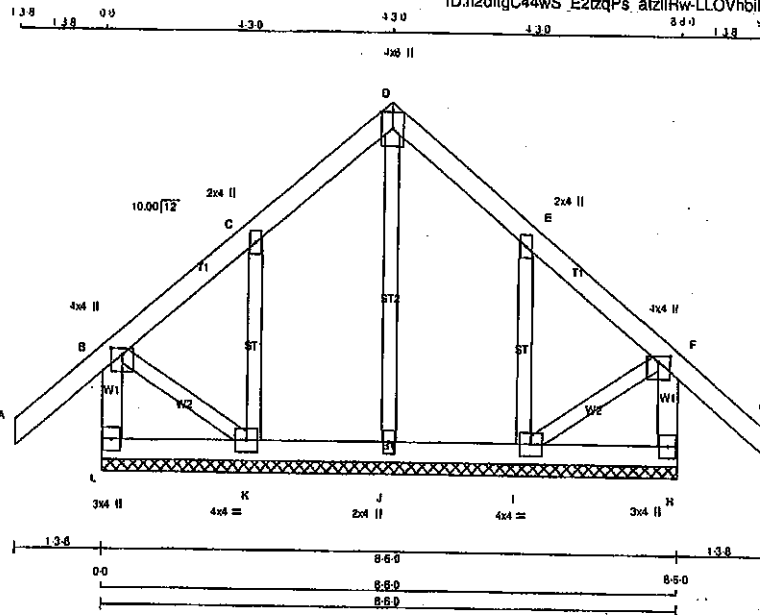

Scale = 1/32"

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
L - B	2x4	DRY	No.2
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - H	2x4	DRY	No.2

ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TMVW+w	MT20	2.0	4.0		
D	TTW+p	MT20	4.0	6.0	Edge	
E	TMVW+w	MT20	2.0	4.0		
F	TMVW+p	MT20	4.0	4.0	1.00	2.00
H	BMV1+p	MT20	3.0	4.0		
I	BMVW1-t	MT20	4.0	4.0		
J	BMV1+w	MT20	2.0	4.0		
K	BMVW1-t	MT20	4.0	4.0		
L	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MEMB.
FR-TO				FR-TO			
L-B	-231/0	0.0	0.0	0.02 (1)	J-D	-123/0	0.05 (1)
A-B	0/41	-91.8	-91.8	0.13 (1)	K-C	-238/0	0.05 (1)
B-C	-11/0	-91.8	-91.8	0.07 (1)	I-E	-238/0	0.05 (1)
C-D	-32/0	-91.8	-91.8	0.07 (1)	B-K	0/23	0.01 (1)
D-E	-32/0	-91.8	-91.8	0.07 (1)	I-F	0/23	0.01 (1)
E-F	-11/0	-91.8	-91.8	0.07 (1)			
F-G	0/41	-91.8	-91.8	0.13 (1)			
H-F	-231/0	0.0	0.0	0.02 (1)			
L-K	0/0	-18.5	-18.5	0.02 (4)			
K-J	0/13	-18.5	-18.5	0.02 (4)			
J-I	0/13	-18.5	-18.5	0.02 (4)			
I-H	0/0	-18.5	-18.5	0.02 (4)			

TOTAL WEIGHT = 42 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.13/1.00 (F-G:1), BC=0.02/1.00 (J-K:4), WB=0.05/1.00 (C-K:1), SS=0.08/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	818	354
	1667	788
	1987	1658


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.18 (C) (INPUT = 0.80)
JSI METAL = 0.13 (C) (INPUT = 1.00)

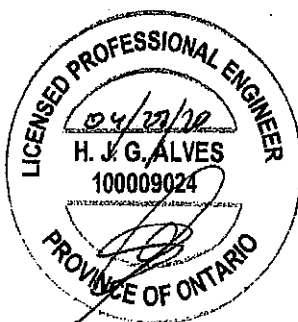

Structural component only
DWG# T-2007078



JSI GRIP= 0.42 (A) (INPUT = 0.90)
JSI METAL= 0.12 (A) (INPUT = 1.00)




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408151	T34	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:20:00 2020 Page 1
ID:h2dlfgC44wS_E2bzqPs_atztlRw-mBc3uRx8GmODTTrpNrn5xkQXdrLlC2aUv0ER7azNCXT

Scale = 1/2"=1'-0"

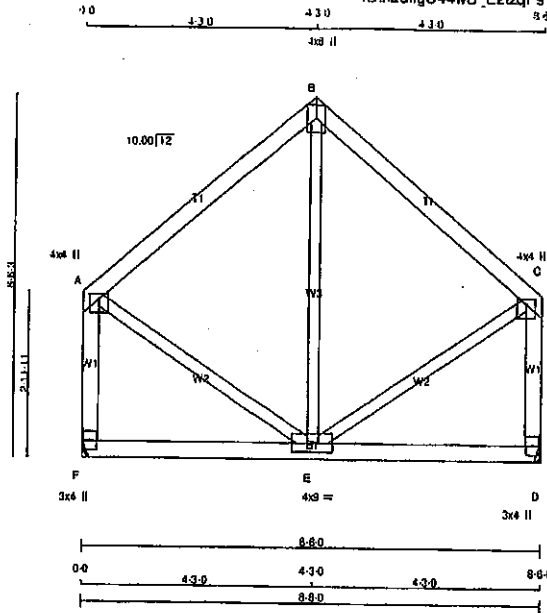

TOTAL WEIGHT = 2 X 41 = 82 lb
(M/F)

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - B	2x4 DRY	No.2	SPF
B - C	2x4 DRY	No.2	SPF
F - A	2x4 DRY	No.2	SPF
D - C	2x4 DRY	No.2	SPF
F - D	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.00	2.00
B	TTW+p	MT20	4.0	6.0	Edge	
C	TMVW+p	MT20	4.0	4.0	1.00	2.00
D	BMV1+p	MT20	3.0	4.0		
E	BMVWW-1	MT20	4.0	9.0		
F	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG	IN-SX	IN-SX
F	469	0	469	0	0	MECHANICAL	
D	469	0	469	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F, D. MINIMUM BEARING LENGTH AT JOINT F = 1-8, JOINT D = 1-8.

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	331	217/0	0/0	0/0	0/0	114/0	0/0
D	331	217/0	0/0	0/0	0/0	114/0	0/0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	-218/0	-91.8	-91.8 0.21 (1)	8.25	E-B	-111/32	0.07 (1)
B-C	-218/0	-91.8	-91.8 0.21 (1)	8.25	A-E	0/197	0.04 (1)
F-A	-438/0	0.0	0.0 0.07 (1)	7.81	E-C	0/197	0.04 (1)
D-C	-438/0	0.0	0.0 0.07 (1)	7.81			
F-E	0/0	-18.5	-18.5 0.09 (4)	10.00			
E-D	0/0	-18.5	-18.5 0.09 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.28")
CALCULATED VERT. DEFL.(LL) = $L/899$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.28")
CALCULATED VERT. DEFL.(TL) = $L/899$ (0.01")

CSI: TC=0.21/1.00 (A-B:1), BC=0.09/1.00 (E-F:4),
WB=0.07/1.00 (B-E:1), SS=0.12/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.33 (A) (INPUT = 0.90)
JSI METAL= 0.09 (A) (INPUT = 1.00)



Structural component only
DWG# T-2007096

JOB NAME 408151	TRUSS NAME T35	QUANTITY 2	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 5 Oct 2019 Mitek Industries, Inc. Sat Apr 25 11:20:01 2020 Page 1	

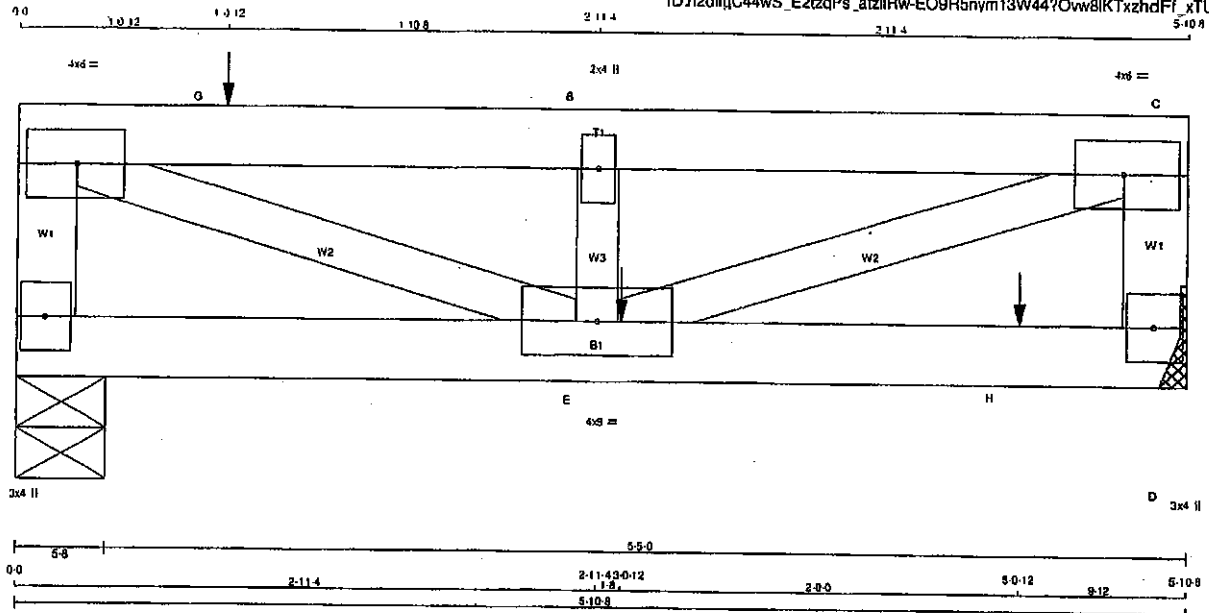

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
F - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN.)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F - A	12	TOP
A - C	12	TOP
C - D	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D	11	SIDE (97.1)
WEBS : (0.122"x3") SPIRAL NAILS		
B - E	8	SIDE (20.3)
2x3	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.
GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (tablets in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMWV-1	MT20	4.0	6.0
B	TMWV-1	MT20	2.0	4.0
C	TMWV-1	MT20	4.0	6.0
D	BMV1+P	MT20	3.0	4.0
E	BMWVW-1	MT20	4.0	6.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER.

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
F	1018	0	1018	0	5-8
D	1085	0	1085	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

UNFACTORED REACTIONS		1ST LOASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
F	726	438 / 0	0 / 0
D	772	479 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.23 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)
F-A	-985 / 0	0.0	0.0	A-E	0 / 1810
A-G	-1706 / 0	-91.8	-91.8	E-B	-482 / 0
G-B	-1706 / 0	-91.8	-91.8	B-C	0 / 1810
B-C	-1706 / 0	-91.8	-91.8	C-D	0 / 1810
D-C	-707 / 0	0.0	0.0		
F-E	0 / 0	-43.5	-43.5		
E-H	0 / 0	-43.5	-43.5		
H-D	0 / 0	-43.5	-43.5		

FACTORED CONCENTRATED LOADS (LBS)		LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	3-0-12	-450	-450	---	---	FRONT	VERT	TOTAL	---	C1
G	1-0-12	-404	-404	---	---	TOP	VERT	TOTAL	---	C1
H	5-0-12	-452	-452	---	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 21.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

*** NON STANDARD GIRDER ***
ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPC 2011, TPC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSI: TC=0.28/1.00 (A-B:1), BC=0.22/1.00 (D-E:1), WB=0.22/1.00 (A-E:1), SSI=0.16/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES		PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PSI)	(PLI)	(PLI)	(PLI)
MT20	618	354	1667	788	1987

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.59 (C) (INPUT = 0.90)
JSI METAL = 0.21 (C) (INPUT = 1.00)

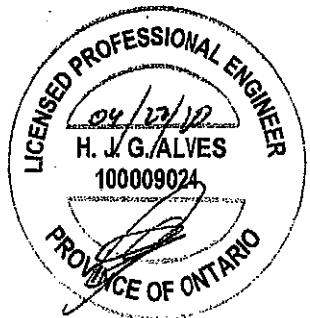


Structural component only
DWG# T-2007097 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.														
408151	T35	2	2	GREEN PARK HOMES															
Tamarack Roof Truss, Burlington				Version 8.310 5 Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 11:20:01 2020 Page 2 ID:h2dflqC44wS E2t2gPs atzllRw-EO9R5nym13W44?Qvw8lKTxzhdfF xTUd8gz flzNCXS															
PLATES (table is in inches) <table border="1"><thead><tr><th>JT</th><th>TYPE</th><th>PLATES</th><th>W</th><th>LEN</th><th>Y</th><th>X</th></tr></thead><tbody><tr><td>F</td><td>8MV1+p</td><td>MT30</td><td>3.0</td><td>4.0</td><td></td><td></td></tr></tbody></table>						JT	TYPE	PLATES	W	LEN	Y	X	F	8MV1+p	MT30	3.0	4.0		
JT	TYPE	PLATES	W	LEN	Y	X													
F	8MV1+p	MT30	3.0	4.0															
 Structural component only DWG# T-2007097 2/2																			

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408151	G36	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 11:19:41 2020 Page 1
ID:h2dlfgC44wS E2zqPs alzlRw-pXytxxDkw7vhw3txxelfk8KIB1VFSmhYZ7xyBzNCXm

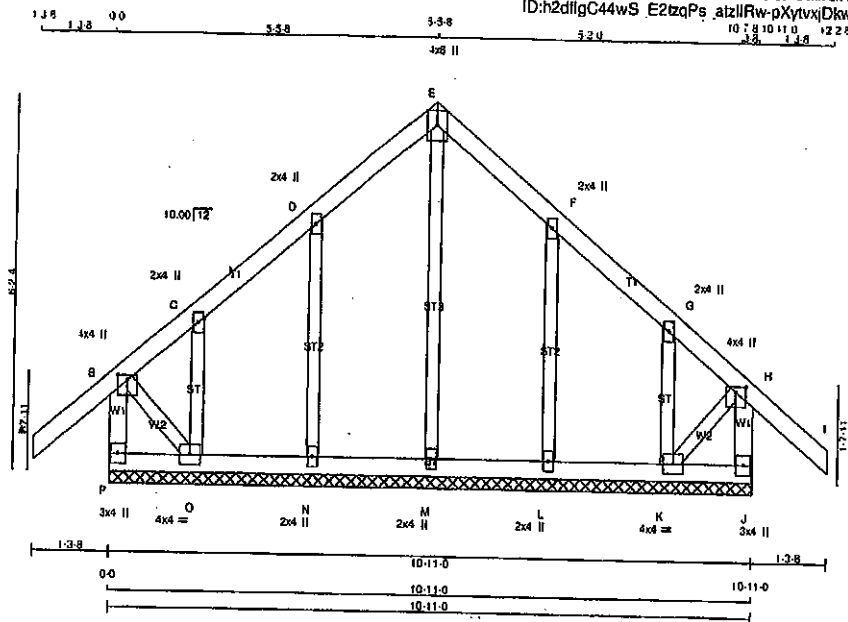

Scale = 1/32

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
P - B	2x4	DRY	No.2		
A - E	2x4	DRY	No.2		
E - I	2x4	DRY	No.2		
J - H	2x4	DRY	No.2		
P - J	2x4	DRY	No.2		

ALL WEBS 2x3 DRY No.2
ALL GABLE WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2'-0\"/>

PLATES (tab) s (n) inches	JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00	
C, D, F, G						
C TMVW+w	MT20	2.0	4.0			
E TTW+p	MT20	4.0	8.0			
H TMVW+p	MT20	4.0	4.0	1.00	2.00	
J BMV1+p	MT20	3.0	4.0			
K BMVW1-t	MT20	4.0	4.0			
L, M, N						
L BMV1+w	MT20	2.0	4.0			
O BMVW1-t	MT20	4.0	4.0			
P BMV1+p	MT20	3.0	4.0			

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
P-B	-274 / 0	0.0	0.0 0.03 (1)	M-E	-139 / 0	0.08 (1)	
A-B	0 / 41	-91.8	-91.8 0.13 (1)	N-D	-223 / 0	0.07 (1)	
B-C	-57 / 0	-91.8	-91.8 0.12 (1)	O-C	-75 / 0	0.01 (1)	
C-D	-4 / 0	-91.8	-91.8 0.06 (1)	L-F	-223 / 0	0.07 (1)	
D-E	-22 / 0	-91.8	-91.8 0.08 (1)	K-G	-75 / 0	0.01 (1)	
E-F	-22 / 0	-91.8	-91.8 0.06 (1)	B-O	0 / 20	0.00 (1)	
F-G	-4 / 0	-91.8	-91.8 0.06 (1)	K-H	0 / 20	0.00 (1)	
G-H	-57 / 0	-91.8	-91.8 0.12 (1)				
H-I	0 / 41	-91.8	-91.8 0.13 (1)				
J-H	-274 / 0	0.0	0.0 0.03 (1)				
P-Q	0 / 0	-18.5	-18.5 0.01 (4)				
O-N	0 / 12	-18.5	-18.5 0.02 (4)				
N-M	0 / 7	-18.5	-18.5 0.02 (4)				
M-L	0 / 7	-18.5	-18.5 0.02 (4)				
L-K	0 / 12	-18.5	-18.5 0.02 (4)				
K-J	0 / 0	-18.5	-18.5 0.01 (4)				

TOTAL WEIGHT = 53 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.13/1.00 (H=1), BC=0.02/1.00 (K=L=4), WB=0.08/1.00 (E=M=1), SSI=0.08/1.00 (A=B=1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
	MAX	MIN	MAX
MT20	818	354	1667
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (B) (INPUT = 0.90)
JSI METAL = 0.12 (F) (INPUT = 1.00)

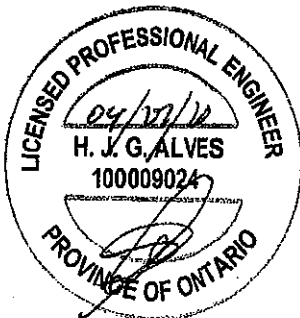



Structural component only
DWG# T-2007079

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408152	T40	1	2	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:28:32 2020 Page 1

ID:17vF7aG0E03cRUj6X1S1SkzWYK-0EA1x1sxZWS34YelZ2E6M8CTQSHDeTgR0n1CQzNCOX

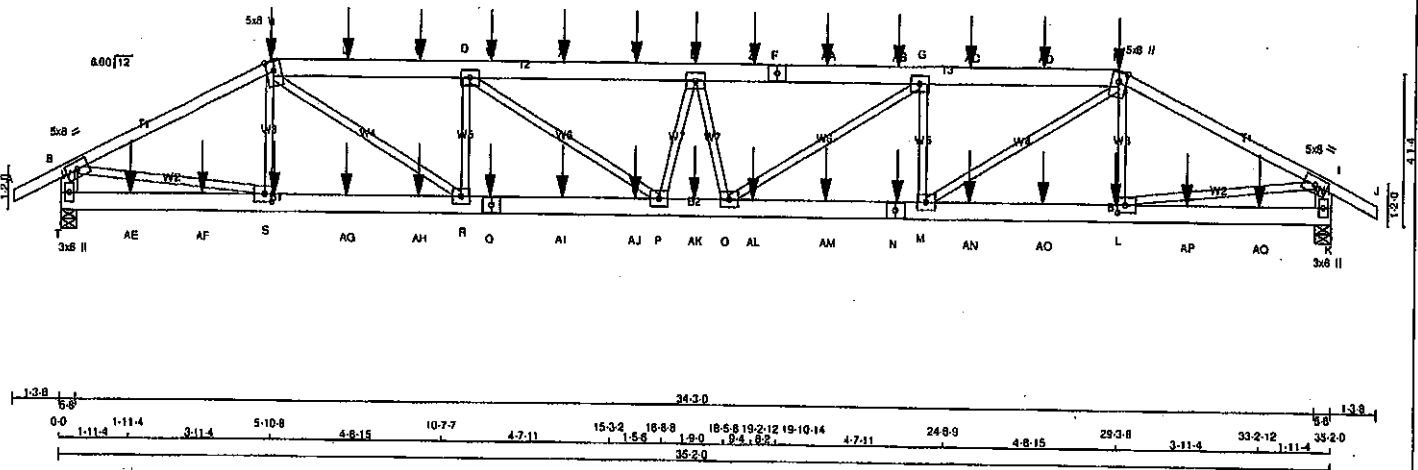

TOTAL WEIGHT = 2 X 170 = 341 lb

LUMBER	SIZE	LUMBER	DESCR.
N. L. G. A. RULES			
CHORDS			
A - C	2x4 DRY	No.2	SPF
C - F	2x6 DRY	No.2	SPF
F - H	2x6 DRY	No.2	SPF
H - J	2x4 DRY	No.2	SPF
T - B	2x6 DRY	No.2	SPF
K - I	2x6 DRY	No.2	SPF
T - Q	2x6 DRY	No.2	SPF
Q - N	2x6 DRY	No.2	SPF
N - K	2x6 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
EXCEPT			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122'X3') SPIRAL NAILS		
A - C	12	SIDE(61.0)
H - J	12	SIDE(61.0)
C - F	12	SIDE(61.0)
F - H	12	SIDE(61.0)
T - B	12	SIDE(61.0)
K - I	12	TOP
BOTTOM CHORDS : (0.122'X3') SPIRAL NAILS		
T - Q	12	SIDE(183.1)
Q - N	12	SIDE(0.0)
N - K	12	SIDE(183.1)
WEBS : (0.122'X3') SPIRAL NAILS		
2x3	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLYS FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED	MAXIMUM FACTORED	INPUT	REQD	
	GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
T	3331	0	3331	0	0
K	3331	0	3331	0	0

UNFACTORED REACTIONS					
	1ST LCASE	MAX. MIN. COMPONENT REACTIONS			
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
T	2356	1544 / 0	0 / 0	0 / 0	812 / 0
K	2356	1544 / 0	0 / 0	0 / 0	812 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.87 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING					
TOTAL LOAD CASES: (4)					
CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO				FR-TO	
A-B	0 / 28	-91.8	-91.8 0.07 (1)	S-C	-427 / 8
B-C	-5077 / 0	-91.8	-91.8 0.52 (1)	C-R	0 / 3083
C-U	-7108 / 0	-91.8	-91.8 0.23 (1)	R-D	-1585 / 0
U-V	-7108 / 0	-91.8	-91.8 0.23 (1)	Q-G	0 / 1071
V-D	-7108 / 0	-91.8	-91.8 0.23 (1)	M-G	-1585 / 0
D-W	-7994 / 0	-91.8	-91.8 0.27 (1)	L-H	-427 / 8
W-X	-7994 / 0	-91.8	-91.8 0.27 (1)	B-S	0 / 4592
X-Y	-7994 / 0	-91.8	-91.8 0.27 (1)	L-I	0 / 4592
Y-E	-7994 / 0	-91.8	-91.8 0.27 (1)	D-P	0 / 1071
E-Z	-7994 / 0	-91.8	-91.8 0.27 (1)	M-H	0 / 3083
Z-F	-7994 / 0	-91.8	-91.8 0.27 (1)	P-E	-505 / 0
A-AA	-7994 / 0	-91.8	-91.8 0.27 (1)	E-O	-505 / 0
AA-AB	-7994 / 0	-91.8	-91.8 0.27 (1)		
AB-G	-7994 / 0	-91.8	-91.8 0.27 (1)		
G-AC	-7108 / 0	-91.8	-91.8 0.23 (1)		
AC-AD	-7108 / 0	-91.8	-91.8 0.23 (1)		
AD-H	-7108 / 0	-91.8	-91.8 0.23 (1)		
H-I	-5077 / 0	-91.8	-91.8 0.52 (1)		
I-J	0 / 28	-91.8	-91.8 0.07 (1)		
T-B	-3255 / 0	0.0	0.0 0.11 (1)		
K-I	-3255 / 0	0.0	0.0 0.11 (1)		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN/C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.39")
CSI: TC=0.52/1.00 (H-I), BC=0.56/1.00 (O-P), WB=0.57/1.00 (B-S), SSI=0.18/1.00 (D-E-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES	PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (S) (INPUT = 0.90)
JSI METAL= 0.84 (N) (INPUT = 1.00)



Structural component only
DWG# T-2007107 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	T40	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 11:29:32 2020 Page 2

ID:7vF?aG0E03cRUj8X1iSrkzWYK-0EA1x1sxZWS34lYeiZ2E6M6CTQSHDeTqR0niCQzNCOX

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMW-1	MT20	5.0	8.0		
C TTWW-m	MT20	5.0	8.0	Edge	
D, E, G					
D TMW-1	MT20	5.0	8.0		
F TS-1	MT20	5.0	6.0		
H TTWW-m	MT20	5.0	8.0	Edge	
I TMW-1	MT20	5.0	8.0		
K BMV1-p	MT20	3.0	6.0		
L BMW-1	MT20	5.0	8.0	2.50	2.50
M, O, P, R					
M BMW-1	MT20	5.0	8.0		
N BS-1	MT20	5.0	8.0		
Q BS-1	MT20	5.0	8.0		
S BMW-1	MT20	5.0	8.0	2.50	2.50
T BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING

TOTAL LOAD CASES: (4)


CHORDS				WEBS			
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX	MAX. MEMB. FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)	MAX. FACTORED CS1 (LC)
FR-TO		FROM TO		UNBRAC			
AQ-K	0.0	-18.5	-18.5	0.08 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-438	-438		FRONT	VERT	TOTAL		C1
E	17-7-0	-110	-110		FRONT	VERT	TOTAL		C1
H	29-3-8	-438	-438		FRONT	VERT	TOTAL		C1
L	29-2-12	-28	-28		FRONT	VERT	TOTAL		C1
N	23-2-12	-28	-28		FRONT	VERT	TOTAL		C1
Q	11-11-4	-28	-28		FRONT	VERT	TOTAL		C1
S	5-11-4	-28	-28		FRONT	VERT	TOTAL		C1
U	7-11-4	-110	-110		FRONT	VERT	TOTAL		C1
V	9-11-4	-110	-110		FRONT	VERT	TOTAL		C1
W	11-11-4	-110	-110		FRONT	VERT	TOTAL		C1
X	13-11-4	-110	-110		FRONT	VERT	TOTAL		C1
Y	15-11-4	-110	-110		FRONT	VERT	TOTAL		C1
Z	19-2-12	-110	-110		FRONT	VERT	TOTAL		C1
AA	21-2-12	-110	-110		FRONT	VERT	TOTAL		C1
AB	23-2-12	-110	-110		FRONT	VERT	TOTAL		C1
AC	25-2-12	-110	-110		FRONT	VERT	TOTAL		C1
AD	27-2-12	-110	-110		FRONT	VERT	TOTAL		C1
AE	1-11-4	-25	-25		FRONT	VERT	TOTAL		C1
AF	3-11-4	-26	-26		FRONT	VERT	TOTAL		C1
AG	7-11-4	-26	-26		FRONT	VERT	TOTAL		C1
AH	9-11-4	-26	-26		FRONT	VERT	TOTAL		C1
AI	13-11-4	-26	-26		FRONT	VERT	TOTAL		C1
AJ	15-11-4	-26	-26		FRONT	VERT	TOTAL		C1
AK	17-7-0	-26	-26		FRONT	VERT	TOTAL		C1
AL	19-2-12	-26	-26		FRONT	VERT	TOTAL		C1
AM	21-2-12	-26	-26		FRONT	VERT	TOTAL		C1
AN	23-2-12	-26	-26		FRONT	VERT	TOTAL		C1
AO	25-2-12	-26	-26		FRONT	VERT	TOTAL		C1
AP	27-2-12	-26	-26		FRONT	VERT	TOTAL		C1
AQ	33-2-12	-25	-25		FRONT	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

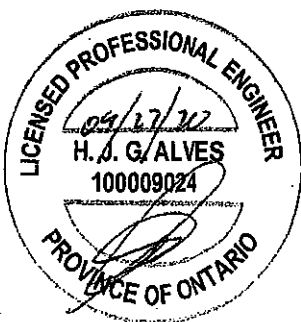


Structural component only
DWG# T-2007107 3/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408152	T40Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:34 2020 Page 1
ID37VF7aG0E03cRU8X15RkzIWYK-ydH2MiuB57mk311?_4iCnCV7E2GhUJzvKGpGJzNCOV

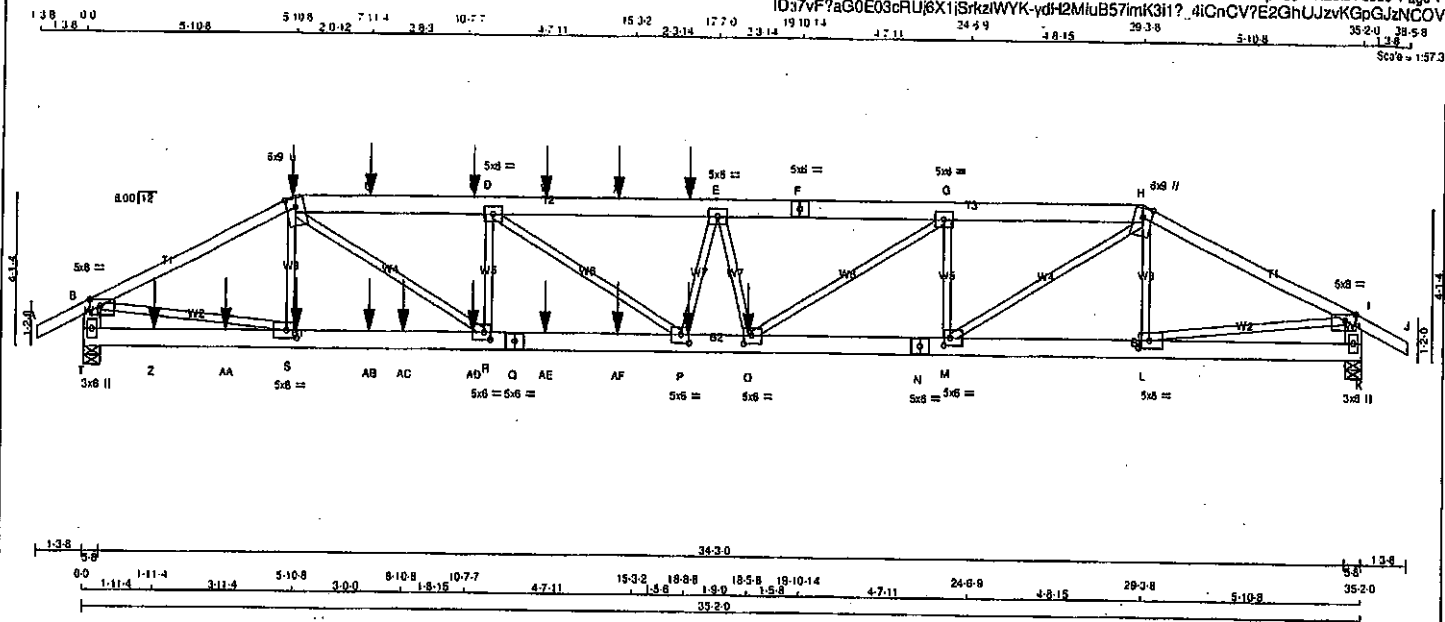

LUMBER	SIZE	DRY	DESCR.
N. L. G. A. RULES			
CHORDS			
A - C	2x4	DRY	No.2
C - F	2x6	DRY	No.2
F - H	2x6	DRY	No.2
H - J	2x4	DRY	No.2
T - B	2x6	DRY	No.2
K - I	2x6	DRY	No.2
T - Q	2x6	DRY	No.2
Q - N	2x6	DRY	No.2
N - K	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS	#ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122'x3') SPIRAL NAILS			
A-C	1	12	SIDE(61.0)
H-J	1	12	TOP
C-F	2	12	SIDE(61.0)
F-H	2	12	TOP
T-B	2	12	TOP
K-I	2	12	TOP
BOTTOM CHORDS : (0.122'x3') SPIRAL NAILS			
T-Q	2	12	SIDE(183.1)
Q-N	2	12	SIDE(0.0)
N-K	2	12	TOP
WEBS : (0.122'x3') SPIRAL NAILS			
2x3	1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	IN-SX	IN-SX
T	4474	0	4474	0
K	3775	0	3775	0

UNFACTORED REACTIONS

	1ST LOASE	MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. WIND	DEAD	SOIL	
T	3162	2088 / 0	0 / 0	0 / 0	1073 / 0	0 / 0	
K	2665	1772 / 0	0 / 0	0 / 0	693 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.19 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MEMB.	FORCE (LBS)
FR-TO			FR-TO	
A-B	0 / 28	-91.8	S-C	-384 / 25
B-C	-7183 / 0	-91.8	C-R	0 / 4687
C-U	-10299 / 0	-91.8	O-G	-2057 / 0
U-V	-10299 / 0	-91.8	O-G	0 / 3611
V-D	-10299 / 0	-91.8	M-G	-2697 / 0
D-W	-12012 / 0	-91.8	L-H	-616 / 0
W-X	-12012 / 0	-91.8	B-S	0 / 6479
X-Y	-12012 / 0	-91.8	L-I	0 / 5333
Y-E	-12012 / 0	-91.8	O-P	0 / 2066
E-F	-12381 / 0	-91.8	M-H	0 / 4850
F-Q	-12381 / 0	-91.8	P-E	-1110 / 0
Q-H	-9388 / 0	-91.8	E-O	0 / 383
H-I	-5688 / 0	-91.8		
I-J	0 / 28	-91.8		
T-B	-4430 / 0	0.0		
K-I	-3718 / 0	0.0		

T-Z	0 / 0	-18.5	-18.5	0.08 (4)	10.00
Z-AA	0 / 0	-18.5	-18.5	0.08 (4)	10.00
AA-S	0 / 0	-18.5	-18.5	0.08 (4)	10.00
S-AB	0 / 6432	-18.5	-18.5	0.08 (1)	10.00
AB-AC	0 / 6432	-18.5	-18.5	0.08 (1)	10.00
AC-AD	0 / 6432	-18.5	-18.5	0.08 (1)	10.00
AD-R	0 / 6432	-18.5	-18.5	0.08 (1)	10.00
R-Q	0 / 10298	-18.5	-18.5	0.08 (1)	10.00
Q-AE	0 / 10298	-18.5	-18.5	0.08 (1)	10.00
AE-AF	0 / 10298	-18.5	-18.5	0.08 (1)	10.00
AF-P	0 / 10298	-18.5	-18.5	0.08 (1)	10.00
P-O	0 / 12285	-18.5	-18.5	0.09 (1)	10.00
O-N	0 / 9385	-18.5	-18.5	0.07 (1)	10.00
N-M	0 / 9385	-18.5	-18.5	0.07 (1)	10.00
M-L	0 / 5303	-18.5	-18.5	0.07 (1)	10.00
L-K	0 / 0	-18.5	-18.5	0.04 (4)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LOC1	MAX.	MAX+	FACE	DIF.	TYPE	HEEL	CONN.
C	5-10-8	-438	-438	---	BACK	VERT	TOTAL	---	C1
O	18-5-8	-2436	-2436	---	BACK	VERT	TOTAL	---	C1
P	16-9-12	-17	-17	---	BACK	VERT	TOTAL	---	C1
S	5-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
U	7-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	10-9-12	-82	-82	---	BACK	VERT	TOTAL	---	C1
W	12-9-12	-82	-82	---	BACK	VERT	TOTAL	---	C1

TOTAL WEIGHT = 2 X 170 = 341 b

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.8	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.31")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/740 (0.57")
CSI: TC=0.71/1.00 (B-C:1), BC=0.91/1.00 (O-P:1),
WB=0.80/1.00 (B-S:1), SS=0.16/1.00 (R-S:1)

DOL LUMBER=1.00 NAIL=1.00 L.S. BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 364	1687 788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (S) (INPUT = 0.90)
JSI METAL = 0.93 (N) (INPUT = 1.00)

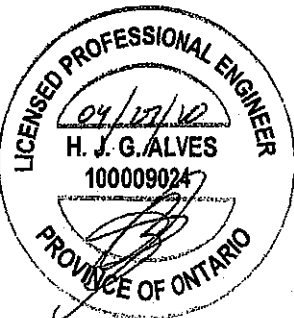

Structural component only
DWG# T-2007108

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	T40Z	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 11:29:34 2020 Page 2
ID:7vF?aG0E03cRU8X1SrkzWYK-vdH2MiuB57ImK3i17 4iCnCV?E2GhUJzvKGnQJzNGOV

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	2.00	3.50
C	TTWW+m	MT20	6.0	9.0	Edge	
D, E, G						
D	TMVW-l	MT20	5.0	6.0		
F	TS-l	MT20	5.0	6.0		
H	TTWW+m	MT20	6.0	9.0	Edge	
I	TMVW-p	MT20	5.0	8.0	2.00	3.50
K	BMVl+p	MT20	3.0	6.0		
L	BMVW-l	MT20	5.0	8.0	2.50	3.50
M	BMVW-l	MT20	5.0	6.0	2.50	2.00
N	BS-l	MT20	5.0	6.0		
O	BMVW-l	MT20	5.0	6.0	2.75	2.75
P	BMVW-l	MT20	6.0	6.0	2.75	2.75
Q	BS-l	MT20	5.0	6.0		
R	BMVW-l	MT20	5.0	6.0	2.50	2.00
S	BMVW-l	MT20	5.0	8.0	2.50	3.50
T	BMVl+p	MT20	3.0	6.0		


Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
X	14-9-12	-82	-82	---	BACK	VERT	TOTAL	---	C1
Y	16-9-12	-82	-82	---	BACK	VERT	TOTAL	---	C1
Z	1-11-4	-25	-26	---	BACK	VERT	TOTAL	---	C1
AA	3-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AB	7-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AC	8-10-8	-639	-639	---	BACK	VERT	TOTAL	---	C1
AD	10-9-12	-17	-17	---	BACK	VERT	TOTAL	---	C1
AE	12-9-12	-17	-17	---	BACK	VERT	TOTAL	---	C1
AF	14-9-12	-17	-17	---	BACK	VERT	TOTAL	---	C1


CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER MECHANICAL CONNECTION IS REQUIRED.

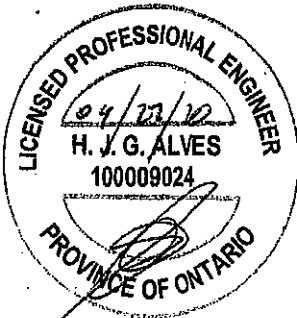

Structural component only
DWG# T-2007108

JOB NAME 408152	TRUSS NAME T41	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:35 2020 Page 1	
ID: i7vF7aG0E03cRUj6X1jSrkiWYK-QpRQa2vprRQdxDHDYhbxk_kd2eSiQx867_0NplzNCOU				35 2.0 35 5.8 35 8.6 35 11.4 35 14.2 35 17.0 35 19.8 35 22.6 35 25.4 35 28.2 35 31.0 35 33.8 35 36.6 35 39.4 35 42.2 35 45.0 35 47.8 35 50.6 35 53.4 35 56.2 35 59.0 35 61.8 35 64.6 35 67.4 35 70.2 35 73.0 35 75.8 35 78.6 35 81.4 35 84.2 35 87.0 35 89.8 35 92.6 35 95.4 35 98.2 35 101.0 35 103.8 35 106.6 35 109.4 35 112.2 35 115.0 35 117.8 35 120.6 35 123.4 35 126.2 35 129.0 35 131.8 35 134.6 35 137.4 35 140.2 35 143.0 35 145.8 35 148.6 35 151.4 35 154.2 35 157.0 35 159.8 35 162.6 35 165.4 35 168.2 35 171.0 35 173.8 35 176.6 35 179.4 35 182.2 35 185.0 35 187.8 35 190.6 35 193.4 35 196.2 35 199.0 35 201.8 35 204.6 35 207.4 35 210.2 35 213.0 35 215.8 35 218.6 35 221.4 35 224.2 35 227.0 35 229.8 35 232.6 35 235.4 35 238.2 35 241.0 35 243.8 35 246.6 35 249.4 35 252.2 35 255.0 35 257.8 35 260.6 35 263.4 35 266.2 35 269.0 35 271.8 35 274.6 35 277.4 35 280.2 35 283.0 35 285.8 35 288.6 35 291.4 35 294.2 35 297.0 35 299.8 35 302.6 35 305.4 35 308.2 35 311.0 35 313.8 35 316.6 35 319.4 35 322.2 35 325.0 35 327.8 35 330.6 35 333.4 35 336.2 35 339.0 35 341.8 35 344.6 35 347.4 35 350.2 35 353.0 35 355.8 35 358.6 35 361.4 35 364.2 35 367.0 35 369.8 35 372.6 35 375.4 35 378.2 35 381.0 35 383.8 35 386.6 35 389.4 35 392.2 35 395.0 35 397.8 35 400.6 35 403.4 35 406.2 35 409.0 35 411.8 35 414.6 35 417.4 35 420.2 35 423.0 35 425.8 35 428.6 35 431.4 35 434.2 35 437.0 35 439.8 35 442.6 35 445.4 35 448.2 35 451.0 35 453.8 35 456.6 35 459.4 35 462.2 35 465.0 35 467.8 35 470.6 35 473.4 35 476.2 35 479.0 35 481.8 35 484.6 35 487.4 35 490.2 35 493.0 35 495.8 35 498.6 35 501.4 35 504.2 35 507.0 35 509.8 35 512.6 35 515.4 35 518.2 35 521.0 35 523.8 35 526.6 35 529.4 35 532.2 35 535.0 35 537.8 35 540.6 35 543.4 35 546.2 35 549.0 35 551.8 35 554.6 35 557.4 35 560.2 35 563.0 35 565.8 35 568.6 35 571.4 35 574.2 35 577.0 35 579.8 35 582.6 35 585.4 35 588.2 35 591.0 35 593.8 35 596.6 35 599.4 35 602.2 35 605.0 35 607.8 35 610.6 35 613.4 35 616.2 35 619.0 35 621.8 35 624.6 35 627.4 35 630.2 35 633.0 35 635.8 35 638.6 35 641.4 35 644.2 35 647.0 35 649.8 35 652.6 35 655.4 35 658.2 35 661.0 35 663.8 35 666.6 35 669.4 35 672.2 35 675.0 35 677.8 35 680.6 35 683.4 35 686.2 35 689.0 35 691.8 35 694.6 35 697.4 35 700.2 35 703.0 35 705.8 35 708.6 35 711.4 35 714.2 35 717.0 35 719.8 35 722.6 35 725.4 35 728.2 35 731.0 35 733.8 35 736.6 35 739.4 35 742.2 35 745.0 35 747.8 35 750.6 35 753.4 35 756.2 35 759.0 35 761.8 35 764.6 35 767.4 35 770.2 35 773.0 35 775.8 35 778.6 35 781.4 35 784.2 35 787.0 35 789.8 35 792.6 35 795.4 35 798.2 35 801.0 35 803.8 35 806.6 35 809.4 35 812.2 35 815.0 35 817.8 35 820.6 35 823.4 35 826.2 35 829.0 35 831.8 35 834.6 35 837.4 35 840.2 35 843.0 35 845.8 35 848.6 35 851.4 35 854.2 35 857.0 35 859.8 35 862.6 35 865.4 35 868.2 35 871.0 35 873.8 35 876.6 35 879.4 35 882.2 35 885.0 35 887.8 35 890.6 35 893.4 35 896.2 35 899.0 35 901.8 35 904.6 35 907.4 35 910.2 35 913.0 35 915.8 35 918.6 35 921.4 35 924.2 35 927.0 35 929.8 35 932.6 35 935.4 35 938.2 35 941.0 35 943.8 35 946.6 35 949.4 35 952.2 35 955.0 35 957.8 35 960.6 35 963.4 35 966.2 35 969.0 35 971.8 35 974.6 35 977.4 35 980.2 35 983.0 35 985.8 35 988.6 35 991.4 35 994.2 35 997.0 35 1000.0	

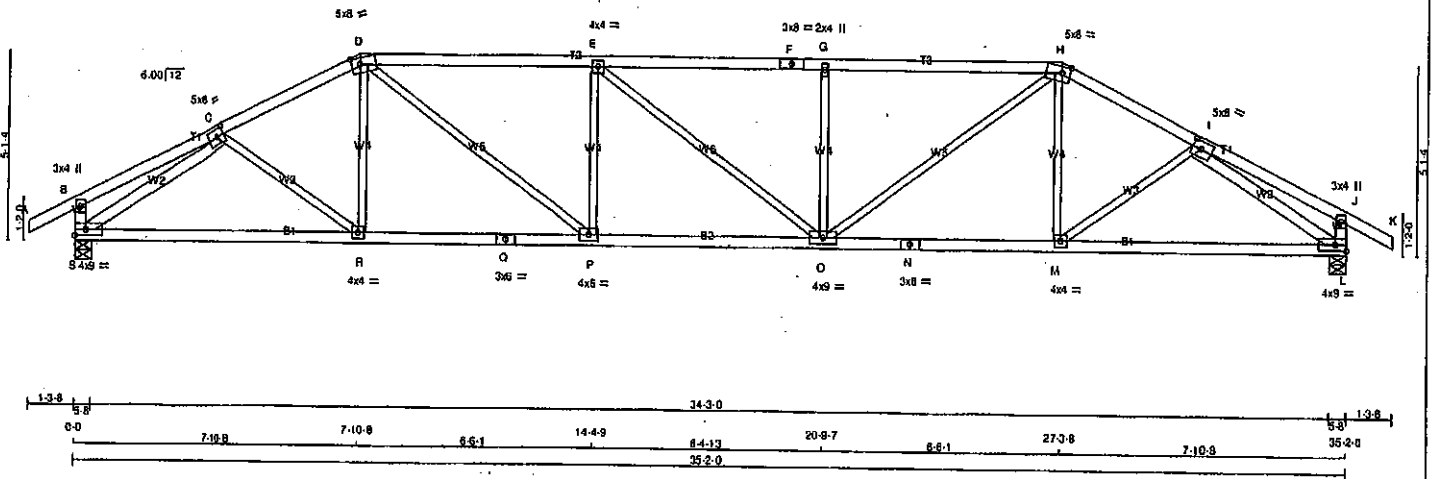

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0
C	TMVW-1	MT20	5.0	8.0 2.50 2.75
D	TMVW-m	MT20	5.0	8.0 2.25 2.75
E	TMVW-1	MT20	4.0	4.0
F	TS-1	MT20	3.0	8.0
G	TMVW-w	MT20	2.0	4.0
H	TMVW-m	MT20	5.0	8.0 2.25 2.75
I	TMVW-1	MT20	5.0	8.0 2.50 2.75
J	TMV+p	MT20	3.0	4.0
L	BMVW-1	MT20	4.0	9.0 Edge
M	BMVW-1	MT20	4.0	4.0
N	BS-1	MT20	3.0	8.0
O	BMVW-1	MT20	4.0	9.0
P	BMVW-1	MT20	4.0	6.0
Q	BS-1	MT20	3.0	8.0
R	BMVW-1	MT20	4.0	4.0
S	BMVW-1	MT20	4.0	9.0 Edge


Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
	FACTORED	MAXIMUM FACTORED	INPUT	REQD					
	GROSS REACTION	GROSS REACTION	BRG	BRG					
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
S	2063	0	2063	0	0	5-8	5-8		
L	2063	0	2063	0	0	5-8	5-8		
UNFACTORED REACTIONS									
1ST LCASE	MAX./MIN. COMPONENT REACTIONS								
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
S	1457	989 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0		
L	1457	989 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L
 BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.94 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
 ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)		
FR-TO					FR-TO				
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	C-R	0 / 93	0.03 (4)		
B-C	0 / 16	-91.8	-91.8 0.20 (1)	10.00	R-D	0 / 121	0.04 (4)		
C-D	-2799 / 0	-91.8	-91.8 0.32 (1)	3.88	D-P	0 / 1267	0.29 (1)		
D-E	-3508 / 0	-91.8	-91.8 0.95 (1)	2.94	P-E	-643 / 0	0.25 (1)		
E-F	-3507 / 0	-91.8	-91.8 0.93 (1)	2.94	E-O	-2 / 0	0.00 (1)		
F-G	-3507 / 0	-91.8	-91.8 0.93 (1)	2.94	O-G	-643 / 0	0.25 (1)		
G-H	-3507 / 0	-91.8	-91.8 0.94 (1)	2.95	O-H	0 / 1266	0.28 (1)		
H-I	-2799 / 0	-91.8	-91.8 0.32 (1)	3.88	H-I	0 / 121	0.04 (4)		
I-J	0 / 16	-91.8	-91.8 0.20 (1)	10.00	M-I	0 / 93	0.03 (4)		
J-K	0 / 28	-91.8	-91.8 0.12 (1)	10.00	S-C	-2974 / 0	0.83 (1)		
S-B	-270 / 0	0.0	0.0 0.03 (1)	7.81	I-L	-2974 / 0	0.83 (1)		
L-J	-270 / 0	0.0	0.0 0.03 (1)	7.81					
S-R	0 / 2417	-18.5	-18.5 0.53 (1)	10.00					
R-Q	0 / 2489	-18.5	-18.5 0.54 (1)	10.00					
Q-P	0 / 2489	-18.5	-18.5 0.54 (1)	10.00					
P-O	0 / 3509	-18.5	-18.5 0.64 (1)	10.00					
O-N	0 / 2489	-18.5	-18.5 0.54 (1)	10.00					
N-M	0 / 2489	-18.5	-18.5 0.54 (1)	10.00					
M-L	0 / 2417	-18.5	-18.5 0.53 (1)	10.00					

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF
SPACING = 24.0 IN C/C	
LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12	
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015	
THIS DESIGN COMPLIES WITH:	
-PART 9 OF BCBC 2018, CBC 2012, ABC 2019	
-PART 9 OF CBC 2012 (2019 AMENDMENT)	
-CSA 088-09, CSA 088-14	
-TPIC 2011, TPIC 2014	
(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD	
ALLOWABLE DEFL.(LL) = L/360 (1.17")	
CALCULATED VERT. DEFL.(LL) = L/889 (0.21")	
ALLOWABLE DEFL.(TL) = L/360 (1.17")	
CALCULATED VERT. DEFL.(TL) = L/889 (0.41")	
CSI: TC=0.95/1.00 (D-E:1), BC=0.64/1.00 (O-P:1), WB=0.83/1.00 (I-L:1), SS=0.28/1.00 (D-E:1)	
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10	
COMPANION LIVE LOAD FACTOR = 1.00	
AUTOSOLVE HEELS OFF	
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.	
NAIL VALUES	
PLATE GRIP(DRY)	SHEAR SECTION
(PSI)	(PLI)
MAX MIN MAX MIN MAX MIN	
MT20	618 354 1967 788 1987 1856
PLATE PLACEMENT TOL. = 0.250 inches	
PLATE ROTATION TOL. = 5.0 Deg.	
JSI GRIP= 0.89 (L) (INPUT = 0.90)	
JSI METAL= 0.77 (N) (INPUT = 1.00)	

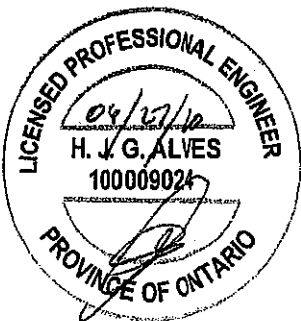


Structural component only
 DWG# T-2007109

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408152	T42	2	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 11:29:36 2020 Page 1

ID:7vF?aG0E03cRUj8X1SkzWYK-u?PpnOvRkyUZNSp6P6AHCHnN1r19RDGMehwLCzNCOT

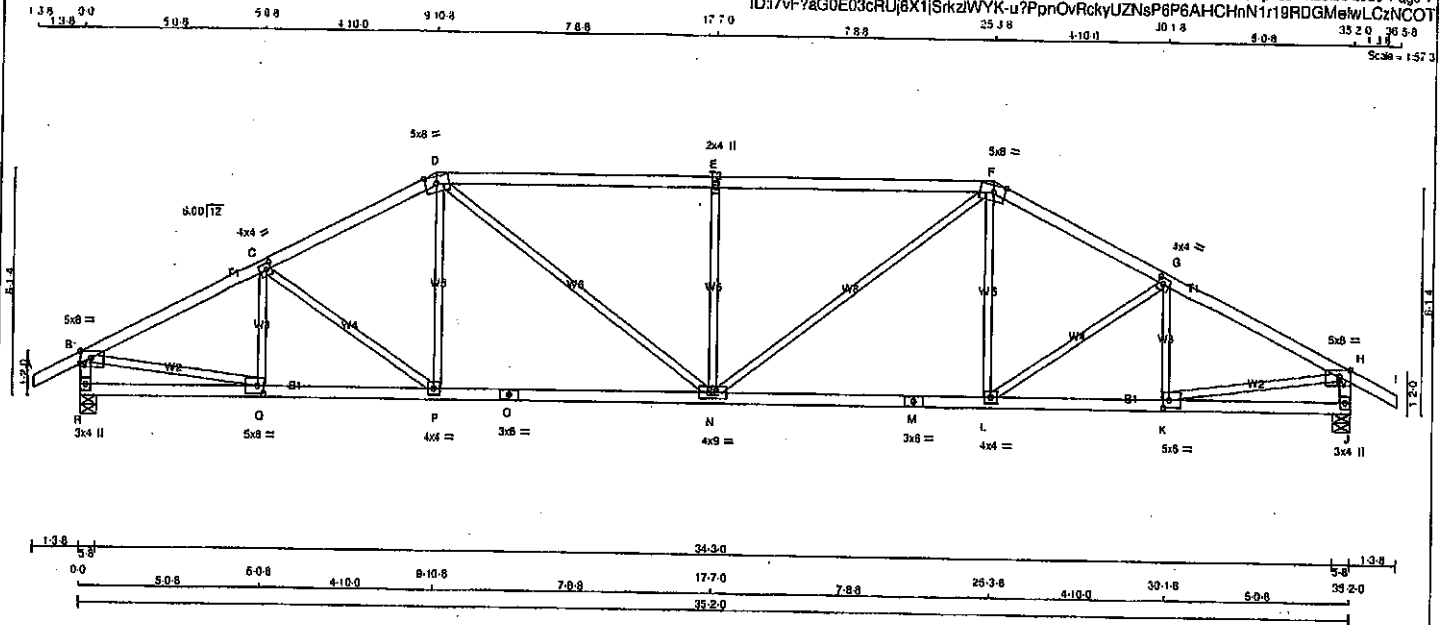

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMWV-p	MT20	5.0	8.0	Edge 3.50
C	TMWV-i	MT20	4.0	4.0	2.00 1.75
D	TTWV-m	MT20	5.0	8.0	2.25 3.75
E	TMW-v	MT20	2.0	4.0	
F	TTWV-m	MT20	5.0	8.0	2.25 3.75
G	TMWV-i	MT20	4.0	4.0	2.00 1.75
H	TMWV-p	MT20	5.0	8.0	Edge 3.50
J	BMV1-p	MT20	3.0	4.0	
K	BMWV-i	MT20	5.0	8.0	2.50 2.00
L	BMWV-i	MT20	4.0	4.0	
M	BS-1	MT20	3.0	8.0	
N	BMWVW-i	MT20	4.0	8.0	
O	BS-1	MT20	3.0	8.0	
P	BMWV-i	MT20	4.0	4.0	
Q	BMWV-i	MT20	5.0	8.0	2.50 2.00
R	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
R	2063	0	2063	0
J	2063	0	2063	0

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
R	COMBINED	SNOW	LIVE	WIND	DEAD	SOIL
J	1457	989 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.78 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	MAX. FACTORED	MEMB.	MAX. FACTORED	FACTORED	MAX. FACTORED
	FORCE	VERT. LOAD	CS (LC)		FORCE	CS (LC)	CS (LC)
FR-TO	(LBS)	FROM TO	CS (LC)	FR-TO	(LBS)	CS (LC)	CS (LC)
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	Q-C	-353 / 0	0.08 (1)
B-C	-2834 / 0	-91.8	-91.8 0.39 (1)	3.81	C-P	-210 / 0	0.13 (1)
C-D	-2887 / 0	-91.8	-91.8 0.37 (1)	3.91	P-D	0 / 246	0.08 (4)
D-E	-3080 / 0	-91.8	-91.8 0.87 (1)	2.78	D-N	0 / 844	0.19 (1)
E-F	-3060 / 0	-91.8	-91.8 0.97 (1)	2.78	N-E	-872 / 0	0.51 (1)
F-G	-2887 / 0	-91.8	-91.8 0.37 (1)	3.91	N-F	0 / 844	0.19 (1)
G-H	-2834 / 0	-91.8	-91.8 0.39 (1)	3.81	L-F	0 / 246	0.08 (4)
H-I	0 / 28	-91.8	-91.8 0.12 (1)	10.00	L-G	-210 / 0	0.13 (1)
R-B	-2018 / 0	0.0	0.0 0.20 (1)	5.94	K-G	-353 / 0	0.08 (1)
J-H	-2018 / 0	0.0	0.0 0.20 (1)	5.94	B-Q	0 / 2591	0.58 (1)
					K-H	0 / 2591	0.58 (1)
R-Q	0 / 0	-18.5	-18.5 0.10 (4)	10.00			
Q-P	0 / 2555	-18.5	-18.5 0.51 (1)	10.00			
P-O	0 / 2386	-18.5	-18.5 0.49 (1)	10.00			
O-N	0 / 2386	-18.5	-18.5 0.49 (1)	10.00			
N-M	0 / 2386	-18.5	-18.5 0.49 (1)	10.00			
M-L	0 / 2386	-18.5	-18.5 0.49 (1)	10.00			
L-K	0 / 2555	-18.5	-18.5 0.51 (1)	10.00			
K-J	0 / 0	-18.5	-18.5 0.10 (4)	10.00			

TOTAL WEIGHT = 2 X 139 = 277 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (1.17")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.17")
ALLOWABLE DEFL. (TL) = $L/360$ (1.17")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.34")
CSI: TC=0.97/1.00 (D-E:1), BC=0.51/1.00 (K-L:1),
WB=0.58/1.00 (H-K:1), SS=0.34/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	818	354	1887
		788	1987
			1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (D) (INPUT = 0.90)
JSI METAL= 0.75 (O) (INPUT = 1.00)

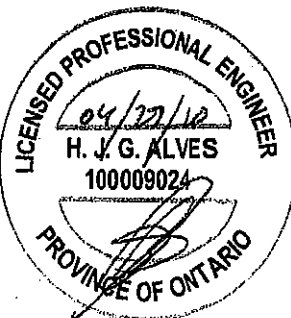


Structural component only
DWG# T-2007110

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408152	T43	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Sat Apr 25 11:29:37 2020 Page 1
ID:17vF2aG0E03cRUj6X1jSkzIWK-MCzB_kw3N24LBWQcg6dPpQ2FRBxutKPbIVT16zNCOS
Scale = 1:37.5

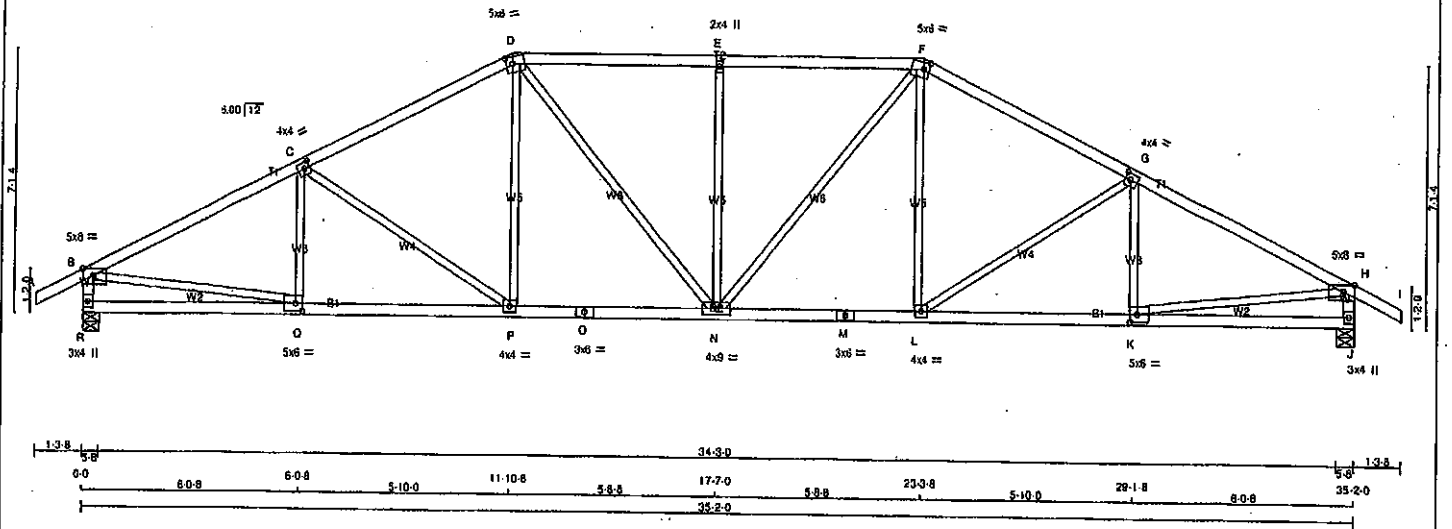

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4 DRY	No.2	SPF
D - F	2x4 DRY	No.2	SPF
F - I	2x4 DRY	No.2	SPF
R - B	2x4 DRY	No.2	SPF
J - H	2x4 DRY	No.2	SPF
H - O	2x4 DRY	No.2	SPF
O - M	2x4 DRY	No.2	SPF
M - J	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	3.0	Edge 3.50	
C TMVW-w	MT20	4.0	4.0	2.00 1.75	
D TTWW-m	MT20	5.0	6.0	2.25 2.00	
E TMVW-w	MT20	2.0	4.0		
F TTWW-m	MT20	5.0	6.0	2.25 2.00	
G TMVW-w	MT20	4.0	4.0	2.00 1.75	
H TMVW-p	MT20	5.0	3.0	Edge 3.50	
J BMV1+p	MT20	3.0	4.0		
K BMVW-1	MT20	5.0	6.0	2.50 2.25	
L BMVW-1	MT20	4.0	4.0		
M BS-1	MT20	3.0	6.0		
N BMVW-1	MT20	4.0	4.0		
O BS-1	MT20	3.0	6.0		
P BMVW-1	MT20	4.0	4.0		
Q BMVW-1	MT20	5.0	6.0	2.50 2.25	
R BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
	FACTORED	MAXIMUM FACTORED	INPUT	REQD					
	GROSS REACTION	GROSS REACTION	BRG	BRG					
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
R	2063	0	2063	0	0	5-8	5-8		
J	2063	0	2063	0	0	5-8	5-8		
UNFACTORED REACTIONS									
1ST CASE	MAX	MIN	COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM	LIVE	WIND	DEAD	SOIL	
R	1457	989 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0		
J	1457	989 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0		
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J									
BRACING									
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.									
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.									
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.									
LOADING									
TOTAL LOAD CASES: (4)									
CHORDS									
MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED	MAX
	FORCE	(PLP)	(PLP)	(LC)	UNBRAC			FORCE	MAX
	(LBS)							(LBS)	CSI (LC)
FR-TO		FROM	TO		LENGTH	FR-TO			
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	Q-C	-255 / 12	0.07 (1)	
B-C	-2689 / 0	-91.8	-91.8	0.58 (1)	3.58	C-P	-435 / 0	0.42 (1)	
C-D	-2539 / 0	-91.8	-91.8	0.52 (1)	3.83	P-D	0 / 350	0.08 (1)	
D-E	-2539 / 0	-91.8	-91.8	0.48 (1)	3.85	D-N	0 / 482	0.11 (1)	
E-F	-2539 / 0	-91.8	-91.8	0.48 (1)	3.85	N-E	-841 / 0	0.56 (1)	
F-G	-2539 / 0	-91.8	-91.8	0.52 (1)	3.83	N-F	0 / 482	0.11 (1)	
G-H	-2689 / 0	-91.8	-91.8	0.58 (1)	3.58	L-F	0 / 350	0.08 (1)	
H-I	0 / 28	-91.8	-91.8	0.12 (1)	10.00	L-G	-435 / 0	0.42 (1)	
R-B	-2014 / 0	0.0	0.0	0.20 (1)	5.95	K-G	-255 / 12	0.07 (1)	
J-H	-2014 / 0	0.0	0.0	0.20 (1)	5.95	B-Q	0 / 2635	0.59 (1)	
						K-H	0 / 2635	0.59 (1)	
R-Q	0 / 0	-18.5	-18.5	0.15 (4)	10.00				
Q-P	0 / 2609	-18.5	-18.5	0.49 (1)	10.00				
P-O	0 / 2249	-18.5	-18.5	0.43 (1)	10.00				
O-N	0 / 2249	-18.5	-18.5	0.43 (1)	10.00				
N-M	0 / 2249	-18.5	-18.5	0.43 (1)	10.00				
M-L	0 / 2249	-18.5	-18.5	0.43 (1)	10.00				
L-K	0 / 2609	-18.5	-18.5	0.49 (1)	10.00				
K-J	0 / 0	-18.5	-18.5	0.15 (4)	10.00				

TOTAL WEIGHT = 2 X 145 = 289 lb

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF
SPACING = 24.0 IN. C/C	
LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12	
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015	
THIS DESIGN COMPLIES WITH:	
- PART 9 OF CBC 2018, CBC 2012, ABC 2019	
- PART 9 OF CBC 2012 (2019 AMENDMENT)	
- CSA 086-09, CSA 086-14	
- TPIC 2011, TPIC 2014	
(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD	
ALLOWABLE DEFL. (LL) = L/360 (1.17")	
CALCULATED VERT. DEFL. (LL) = L/999 (0.15")	
ALLOWABLE DEFL. (TL) = L/360 (1.17")	
CALCULATED VERT. DEFL. (TL) = L/999 (0.28")	
CSI: TC=0.58/1.00 (G-H:1), BC=0.49/1.00 (K-L:1), WB=0.58/1.00 (B-Q:1), SS=0.25/1.00 (D-E:1)	
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10	
COMP=1.10 SHEAR=1.10 TENS=1.10	
COMPANION LIVE LOAD FACTOR = 1.00	
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.	
NAIL VALUES	
PLATE GRIP (DRY)	SHEAR SECTION
(PSI)	(PLI)
MAX MIN	MAX MIN
MT20	618 354 1887 788 1987 1858
PLATE PLACEMENT TOL = 0.250 inches	
PLATE ROTATION TOL = 5.0 Deg.	
JSI GRIP = 0.89 (Q) (INPUT = 0.90)	
JSI METAL = 0.89 (M) (INPUT = 1.00)	




Structural component only
DWG# T-2007111

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408152	T44	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 11:29:38 2020 Page 1
ID:17vF7aG0E03cRUj8X1jSkziWYK-roXZC4xiBMCCog7oEq9eMdMA6/WEDKWYqyF1P4zNCOR

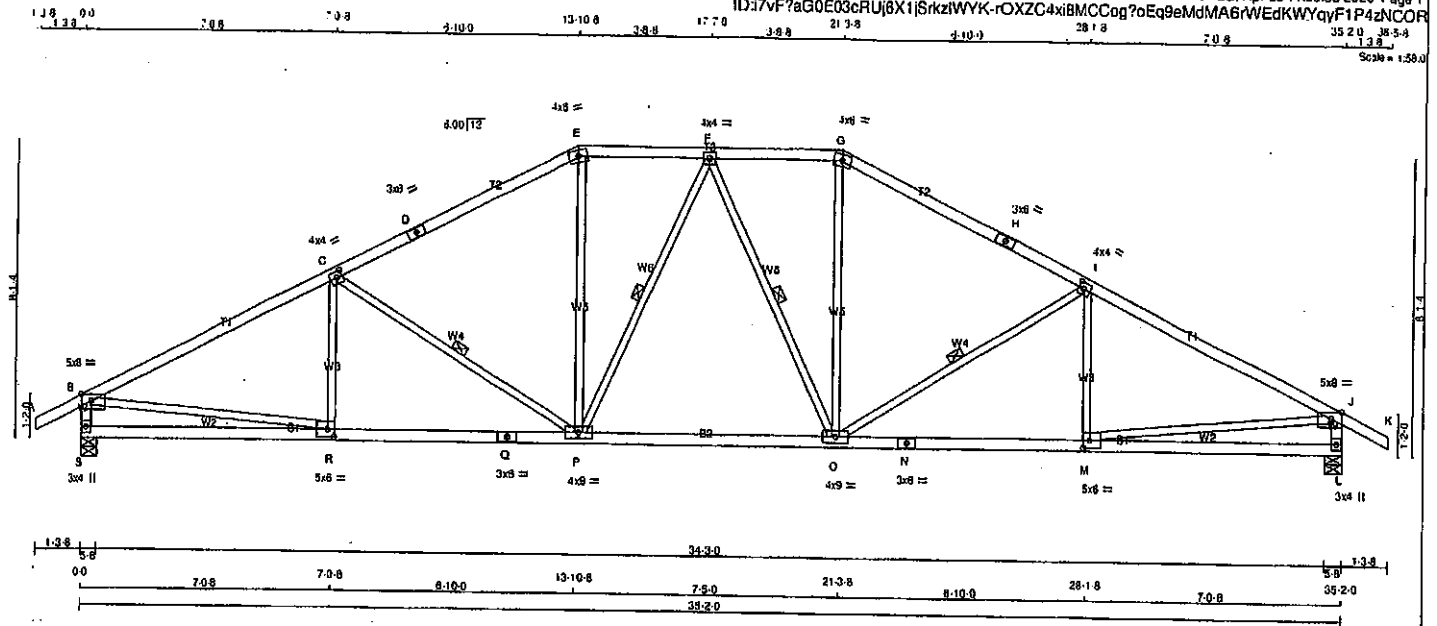

LUMBER	SIZE	LUMBER	DESCR.
N. L. G. A. RULES			
CHORDS			
A - D	2x4	DRY	No.2
E - G	2x4	DRY	No.2
H - K	2x4	DRY	No.2
L - N	2x4	DRY	No.2
O - Q	2x4	DRY	No.2
R - S	2x4	DRY	No.2
T - U	2x4	DRY	No.2
V - W	2x4	DRY	No.2
X - Y	2x4	DRY	No.2
Z	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
	FACTORED	MAXIMUM FACTORED	INPUT	RECORD					
JT	GROSS REACTION	GROSS REACTION	BRG	BRG					
S	2083	0	2083	0	5-8	5-8			
L	2083	0	2083	0	5-8	5-8			
UNFACTORED REACTIONS									
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
S	1457	989 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0		
L	1457	989 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0		
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L									
BRACING									
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.25 FT.									
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.									
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.									
1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-P, F-P, F-O, I-O.									
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW									
LOADING									
TOTAL LOAD CASES: (4)									

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF
SPACING = 24.0 IN./C	
LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12	
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015	
THIS DESIGN COMPLIES WITH:	
- PART 9 OF CBC 2018, OBC 2012, ABC 2019	
- PART 9 OF OBC 2012 (2019 AMENDMENT)	
- CSA 086-09, CSA 086-14	
- TPIC 2011, TPIC 2014	
(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD	
ALLOWABLE DEFL.(LL) = L/360 (1.17)	
CALCULATED VERT. DEFL.(LL) = L/989 (0.14)	
ALLOWABLE DEFL.(TL) = L/360 (1.17)	
CALCULATED VERT. DEFL.(TL) = L/989 (0.30)	
CSI: TC=0.83/1.00 (I-J:1), BC=0.52/1.00 (M-O:1), WB=0.60/1.00 (B-R:1), SSI=0.28/1.00 (I-J:1)	
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10	
COMPANION LIVE LOAD FACTOR = 1.00	
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.	
NAIL VALUES	
PLATE GRIP(DRY) SHEAR	SECTION
(PSI)	(PLI)
MAX MIN MAX MIN MAX MIN	
MT20	818 354 1667 788 1987 1658
PLATE PLACEMENT TOL. = 0.250 inches	
PLATE ROTATION TOL. = 5.0 Deg.	
JSI GRIP= 0.86 (M) (INPUT = 0.90)	
JSI METAL= 0.79 (N) (INPUT = 1.00)	

PLATES (table in inches)	W	LEN	Y	X
JT TYPE PLATES				
B TMWW-p	MT20	5.0	8.0	Edge 3.50
C TMWW-1	MT20	4.0	4.0	2.00 1.75
D TS-1	MT20	3.0	6.0	
E ITW-m	MT20	4.0	8.0	
F TMWW-1	MT20	4.0	4.0	
G ITW-m	MT20	4.0	8.0	
H TS-1	MT20	3.0	6.0	
I TMWW-1	MT20	4.0	4.0	2.00 1.75
J TMWW-p	MT20	5.0	8.0	Edge 3.50
L BMV1-p	MT20	3.0	4.0	
M BMWW-1	MT20	5.0	8.0	2.50 2.25
N BS-1	MT20	3.0	6.0	
O BMWW-1	MT20	4.0	9.0	
P BMWW-1	MT20	4.0	9.0	
Q BS-1	MT20	3.0	6.0	
R BMWW-1	MT20	5.0	8.0	2.50 2.25
S BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	CS1 (LC)	MAX. UNBRACED LENGTH	MEMB.	FORCE (LBS)	MAX. UNBRACED LENGTH	MEMB.	FORCE (LBS)
FR-TO		FROM TO			FR-TO			FR-TO	
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	R-Q	-182 / 52	0.06 (1)		
B-C	-2906 / 0	-91.8	-91.8 0.52 (1)	3.25	C-P	-637 / 0	0.29 (1)		
C-D	-2373 / 0	-91.8	-91.8 0.72 (1)	3.66	P-E	0 / 674	0.15 (1)		
D-E	-2373 / 0	-91.8	-91.8 0.72 (1)	3.66	F-O	-222 / 0	0.11 (1)		
E-F	-2100 / 0	-91.8	-91.8 0.19 (1)	4.53	F-O	-222 / 0	0.11 (1)		
F-G	-2100 / 0	-91.8	-91.8 0.19 (1)	4.53	O-I	0 / 674	0.15 (1)		
G-H	-2373 / 0	-91.8	-91.8 0.72 (1)	3.66	M-I	-182 / 52	0.06 (1)		
H-I	-2373 / 0	-91.8	-91.8 0.72 (1)	3.66	M-I	-182 / 52	0.06 (1)		
I-J	-2906 / 0	-91.8	-91.8 0.52 (1)	3.25	B-R	0 / 2649	0.80 (1)		
J-K	0 / 28	-91.8	-91.8 0.12 (1)	10.00	M-J	0 / 2649	0.80 (1)		
S-B	-2008 / 0	0.0	0.0 0.20 (1)	5.98					
L-J	-2008 / 0	0.0	0.0 0.20 (1)	5.98					
S-R	0 / 0	-18.5	-18.5 0.20 (4)	10.00					
R-Q	0 / 2630	-18.5	-18.5 0.52 (1)	10.00					
Q-P	0 / 2630	-18.5	-18.5 0.52 (1)	10.00					
P-O	0 / 2193	-18.5	-18.5 0.45 (1)	10.00					
O-N	0 / 2630	-18.5	-18.5 0.52 (1)	10.00					
N-M	0 / 2630	-18.5	-18.5 0.52 (1)	10.00					
M-L	0 / 0	-18.5	-18.5 0.20 (4)	10.00					



Structural component only
DWG# T-2007112


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408152	T45	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Sat Apr 25 11:29:39 2020 Page 1

ID:17vF7aG0E03cRUj8X1jSkzIWYK-Ja5xPQyKvIK3Qqa_nXgtvqRdFrwMjini2c_ayWzNCOOQ

Scale = 1/8" = 1'-0"

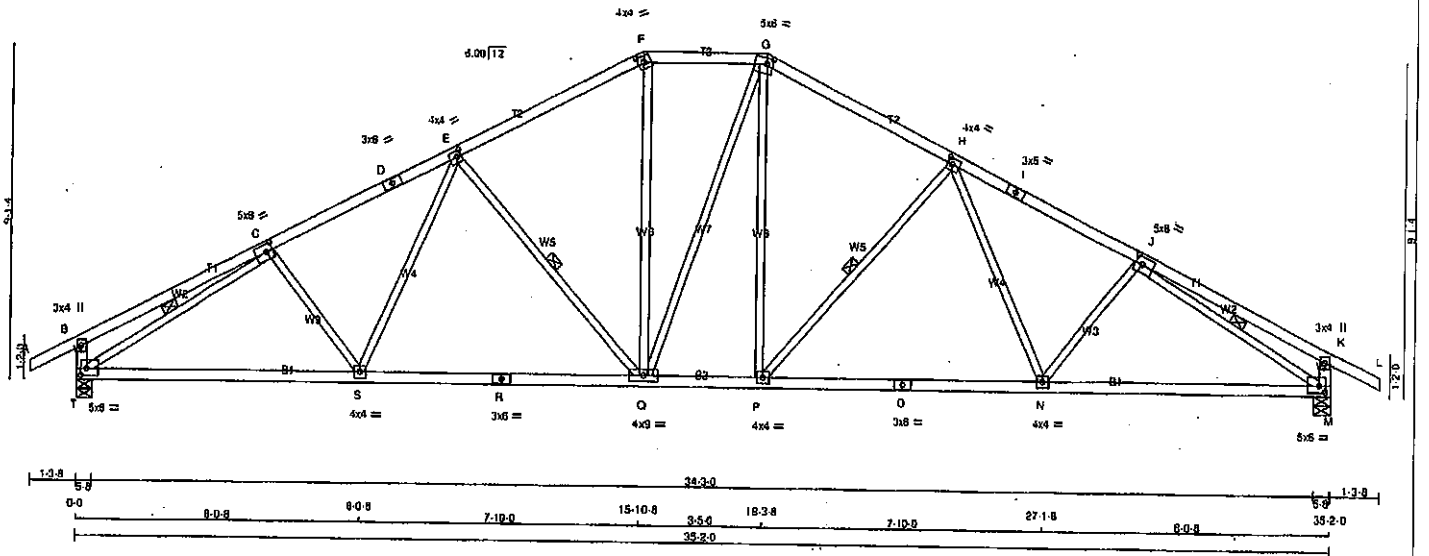

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - K	2x4	DRY	No.2
K - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	UPLIFT	IN-SX
T	2063	0	0	5-8
M	2063	0	0	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
T	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0
M	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. FURLIN SPACING = 3.66 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-Q, H-P, C-T, J-M

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	C-S	-110 / 37
B-C	0 / 19	-91.8	-91.8	0.32 (1)	10.00	S-E	0 / 276
C-D	-2759 / 0	-91.8	-91.8	0.40 (1)	3.66	E-Q	-681 / 0
D-E	-2759 / 0	-91.8	-91.8	0.40 (1)	3.66	Q-F	0 / 813
E-F	-2187 / 0	-91.8	-91.8	0.38 (1)	4.30	Q-G	0 / 4
F-G	-1925 / 0	-91.8	-91.8	0.38 (1)	4.30	P-G	0 / 609
G-H	-2166 / 0	-91.8	-91.8	0.36 (1)	4.30	H-N	-882 / 0
H-I	-2760 / 0	-91.8	-91.8	0.40 (1)	3.66	N-J	0 / 276
I-J	-2760 / 0	-91.8	-91.8	0.40 (1)	3.66	N-N	-110 / 37
J-K	0 / 19	-91.8	-91.8	0.32 (1)	10.00	T-C	-3940 / 0
K-L	0 / 28	-91.8	-91.8	0.12 (1)	10.00	J-M	-3041 / 0
T-B	-328 / 0	0.0	0.0	0.03 (1)	7.81		
M-K	-328 / 0	0.0	0.0	0.03 (1)	7.81		
T-S	0 / 2536	-18.5	-18.5	0.55 (1)	10.00		
S-R	0 / 2362	-18.5	-18.5	0.53 (1)	10.00		
R-Q	0 / 2362	-18.5	-18.5	0.53 (1)	10.00		
Q-P	0 / 1924	-18.5	-18.5	0.40 (1)	10.00		
P-O	0 / 2362	-18.5	-18.5	0.53 (1)	10.00		
O-N	0 / 2362	-18.5	-18.5	0.53 (1)	10.00		
N-M	0 / 2537	-18.5	-18.5	0.56 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. G.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.15")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.32")

CSK TC=0.40/1.00 (H-J:1), BC=0.56/1.00 (M-N:1), WB=0.85/1.00 (J-M:1), SS=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PS)	SECTION (PL)
MT20	618	354
	1887	788
	1887	1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.89 (M) (INPUT = 0.90)
JSI METAL = 0.83 (O) (INPUT = 1.00)

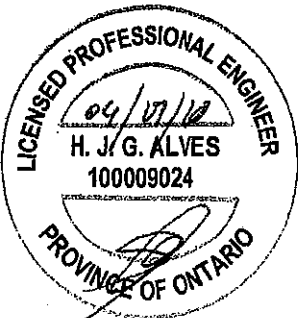

Structural component only
DWG# T-2007113

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 11:29:41 2020 Page 1
ID:7fVf?aG0E03cRU6X1jSkzIYWYK-FzCig6aZRhbg98KNyil_F_md2XrqIH?WwTh0PzNCOO
3.9.9 33.4.8 5.9.6 29.2.4 6.0.0 JS-2.0' 36.5.8
Scale=1:54.1

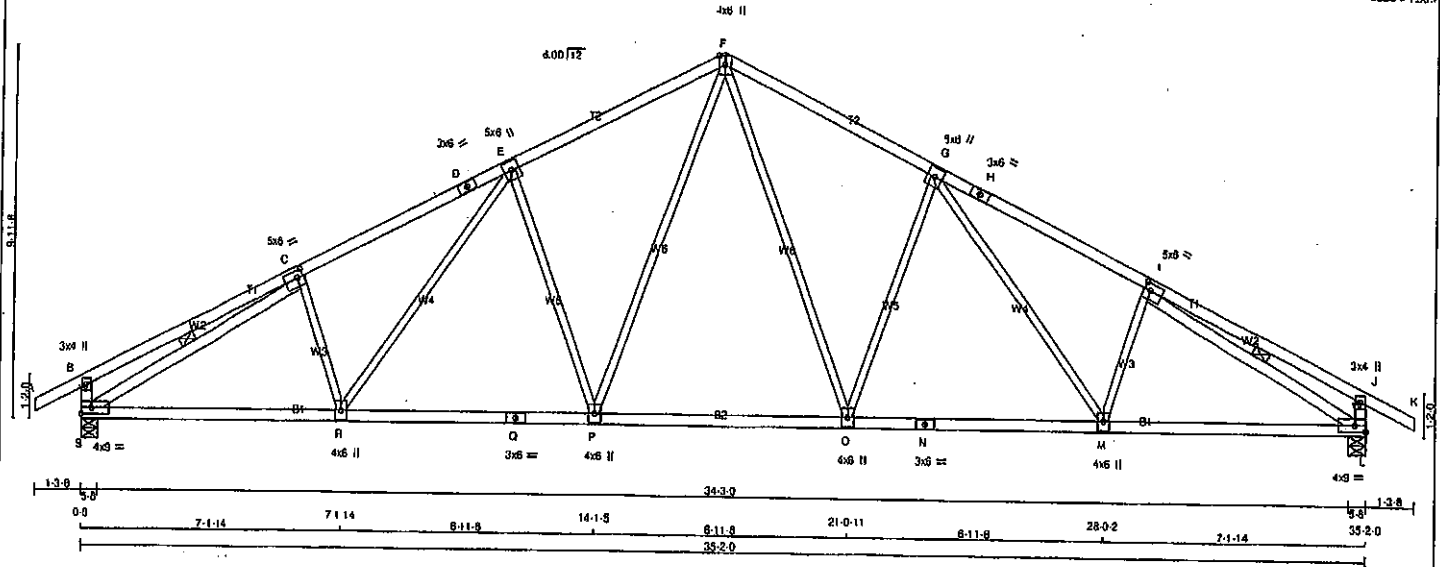

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE		LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY; SEASONED LUMBER.

PLATES (table is in inches)		PLATES		W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0			
C	TMVW+i	MT20	5.0	6.0		2.25	2.00
D	TS-i	MT20	3.0	6.0			
E	TMVW+i	MT20	5.0	6.0			
F	TTWV+p	MT20	4.0	6.0	Edge		
G	TMVW+i	MT20	5.0	6.0			
H	TS-i	MT20	3.0	6.0			
I	TMVW+i	MT20	5.0	6.0		2.25	2.00
J	TMV+p	MT20	3.0	4.0			
L	BMVW-i	MT20	4.0	9.0	Edge		
M, O, P, R							
M	BMVW+i	MT20	4.0	6.0			
N	BS-i	MT20	3.0	8.0			
Q	BS-i	MT20	3.0	6.0			
S	BMVW-i	MT20	4.0	9.0	Edge		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.



Structural component only
DWG# T-2007114

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REORD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
S	2083	0	2083	0	0	5-8	5-8
L	2083	0	2083	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST/CASE		MAX./MIN. COMPONENT REACTIONS					
JS	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S. L.

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-S, I-L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS			WEBBS					
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD	LC1	MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM	TO			FR-TO		
A-B	0/28	-91.8	-91.8	0.12 (1)	10.00	F-O	0/866	0.19 (1)
B-C	0/22	-91.8	-91.8	0.40 (1)	10.00	C-G	-728/0	0.72 (1)
C-D	-2808/0	-91.8	-91.8	0.49 (1)	3.75	G-M	0/391	0.09 (1)
D-E	-2808/0	-91.8	-91.8	0.49 (1)	3.75	M-I	-192/18	0.05 (1)
E-F	-2322/0	-91.8	-91.8	0.46 (1)	4.07	P-F	0/866	0.19 (1)
F-G	-2322/0	-91.8	-91.8	0.46 (1)	4.07	E-P	-726/0	0.72 (1)
G-H	-2808/0	-91.8	-91.8	0.49 (1)	3.75	R-E	0/391	0.09 (1)
H-I	-2808/0	-91.8	-91.8	0.49 (1)	3.75	C-R	-192/18	0.05 (1)
I-J	0/22	-91.8	-91.8	0.40 (1)	10.00	S-C	-3064/0	0.72 (1)
J-K	0/28	-91.8	-91.8	0.12 (1)	10.00	I-L	-3064/0	0.72 (1)
S-B	-344/0	0.0	0.0	0.03 (1)	7.81			
L-J	-344/0	0.0	0.0	0.03 (1)	7.81			

S-R	0/2574	-18.5	-18.5	0.53 (1)	10.00
R-Q	0/2291	-18.5	-18.5	0.47 (1)	10.00
Q-P	0/2291	-18.5	-18.5	0.47 (1)	10.00
P-O	0/1762	-18.5	-18.5	0.38 (1)	10.00
O-N	0/2291	-18.5	-18.5	0.47 (1)	10.00
N-M	0/2291	-18.5	-18.5	0.47 (1)	10.00
M-L	0/2574	-18.5	-18.5	0.53 (1)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD			=	39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018 , OBC 2012 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= $L/360$ (1.17")
 CALCULATED VERT. DEFL.(LL) = $L/999$ (0.14")
 ALLOWABLE DEFL.(TL)= $L/360$ (1.17")
 CALCULATED VERT. DEFL.(TL) = $L/999$ (0.28")

CSI: TC=0.49/1.00 (C-E:1), BC=0.53/1.00 (L-M:1),
WB=0.72/1.00 (E-P:1), SS=0.22/1.00 (J-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1651


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL. ≈ 5.0 Deg.

JSI GRIP= 0.87 (C) (INPUT = 0.90)
JSI METAL= 0.77 (B) (INPUT = 1.00)

JOB NAME 408152	TRUSS NAME T47	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 3.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 11:29:42 2020 Page 1
 ID:7vF?aG0E03cRUj6X1jSkzjWYK-9m42R_OCajeHJZTfDaWTxGSyYZ0D8kZDEYrzNCON

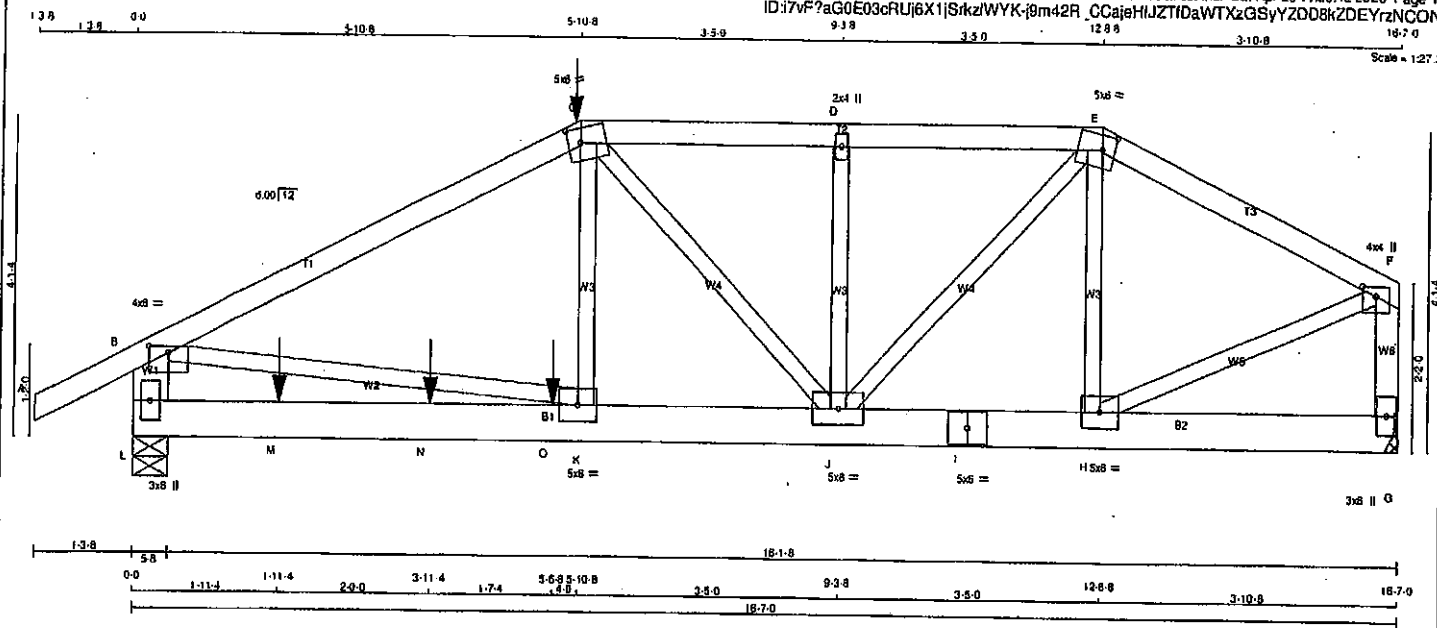

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
L - B	2x6	DRY	No.2
G - F	2x4	DRY	No.2
L - I	2x6	DRY	No.2
I - G	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.
 DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS	#ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS			
A-C	1	12	SIDE (61.0)
C-E	1	12	SIDE (61.0)
E-F	1	12	TOP
G-F	1	12	TOP
L-B	2	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS			
L-I	2	12	SIDE (0.0)
I-G	2	12	TOP
WEBS: (0.122"x3") SPIRAL NAILS			
2x3	1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.
 GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	UPLIFT
L	2005	0	0
G	1397	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 2-0.

UNFACTORED REACTIONS							
1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
JT	1412	958 / 0	0 / 0	0 / 0	0 / 0	457 / 0	0 / 0
G	985	662 / 0	0 / 0	0 / 0	0 / 0	323 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L.

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.16 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. GSI (LC)
FR-TO			
A-B	0 / 28	-91.8	-91.8 0.07 (1)
B-C	-2843 / 0	-91.8	-91.8 0.37 (1)
C-D	-1951 / 0	-91.8	-91.8 0.10 (1)
D-E	-1951 / 0	-91.8	-91.8 0.10 (1)
E-F	-1405 / 0	-91.8	-91.8 0.14 (1)
L-B	-1885 / 0	0.0	0.0 0.07 (1)
G-F	-1369 / 0	0.0	0.0 0.08 (1)
L-M	0 / 0	-18.5	-18.5 0.10 (1)
M-N	0 / 0	-18.5	-18.5 0.10 (1)
N-O	0 / 0	-18.5	-18.5 0.10 (1)
O-K	0 / 0	-18.5	-18.5 0.10 (1)
K-J	0 / 2389	-18.5	-18.5 0.24 (1)
J-I	0 / 1243	-18.5	-18.5 0.11 (1)
I-H	0 / 1243	-18.5	-18.5 0.11 (1)
H-G	0 / 0	-18.5	-18.5 0.02 (4)

FACTORED CONCENTRATED LOADS (LBS)			
JT	LOC.	LC1	MAX. MAX+
C	5-10-8	320	320
M	1-11-4	-25	-25
N	3-11-4	-26	-26
O	5-6-8	-1076	-1076

CONNECTION REQUIREMENTS			
1)	C1	A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.	

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C
 LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.55")
 CALCULATED VERT. DEFL. (LL) = L/899 (0.03")
 ALLOWABLE DEFL. (TL) = L/360 (0.55")
 CALCULATED VERT. DEFL. (TL) = L/899 (0.06")

CSI: TC=0.37/1.00 (B-C:1), 8C=0.24/1.00 (J-K:1), WB=0.29/1.00 (B-K:1), SSI=0.37/1.00 (K-L:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP (DRY)	SHEAR	SECTION	
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	818	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.80 (B) (INPUT = 0.90)
 JSI METAL=0.32 (B) (INPUT = 1.00)

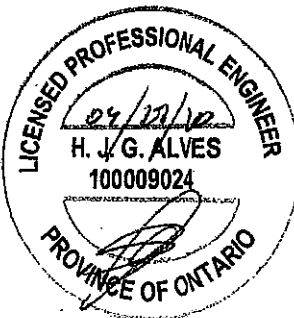


Structural component only
 DWG# T-2007115 1/1

JOB NAME 408152	TRUSS NAME T47	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRAWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	


Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Sat Apr 25 11:29:42 2020 Page 2
IDi7vF?aG0E03cRUlBx1ISkzIWYK-i9m42R CCaleHlJZTIDaWTXzGSyYZDD8kZDEYrzNCON

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	6.0	1.00	3.00
C	TTWW-m	MT20	5.0	6.0	2.25	2.00
D	TMW-w	MT20	2.0	4.0		
E	TTWW-m	MT20	5.0	6.0	2.25	2.00
F	TMVW-p	MT20	4.0	4.0	1.50	2.00
G	BMV1-p	MT20	3.0	6.0		
H	BMWW-1	MT20	5.0	6.0		
I	BS-1	MT20	5.0	6.0		
J	BMWW-1	MT20	5.0	6.0		
K	BMWW-1	MT20	5.0	6.0		
L	BMV1-p	MT20	3.0	6.0		

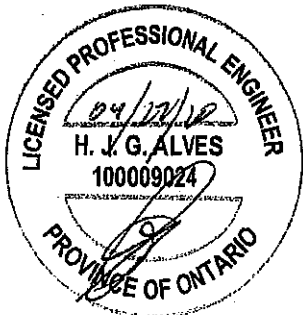

Structural component only
DWG# T-2007115 *ML*

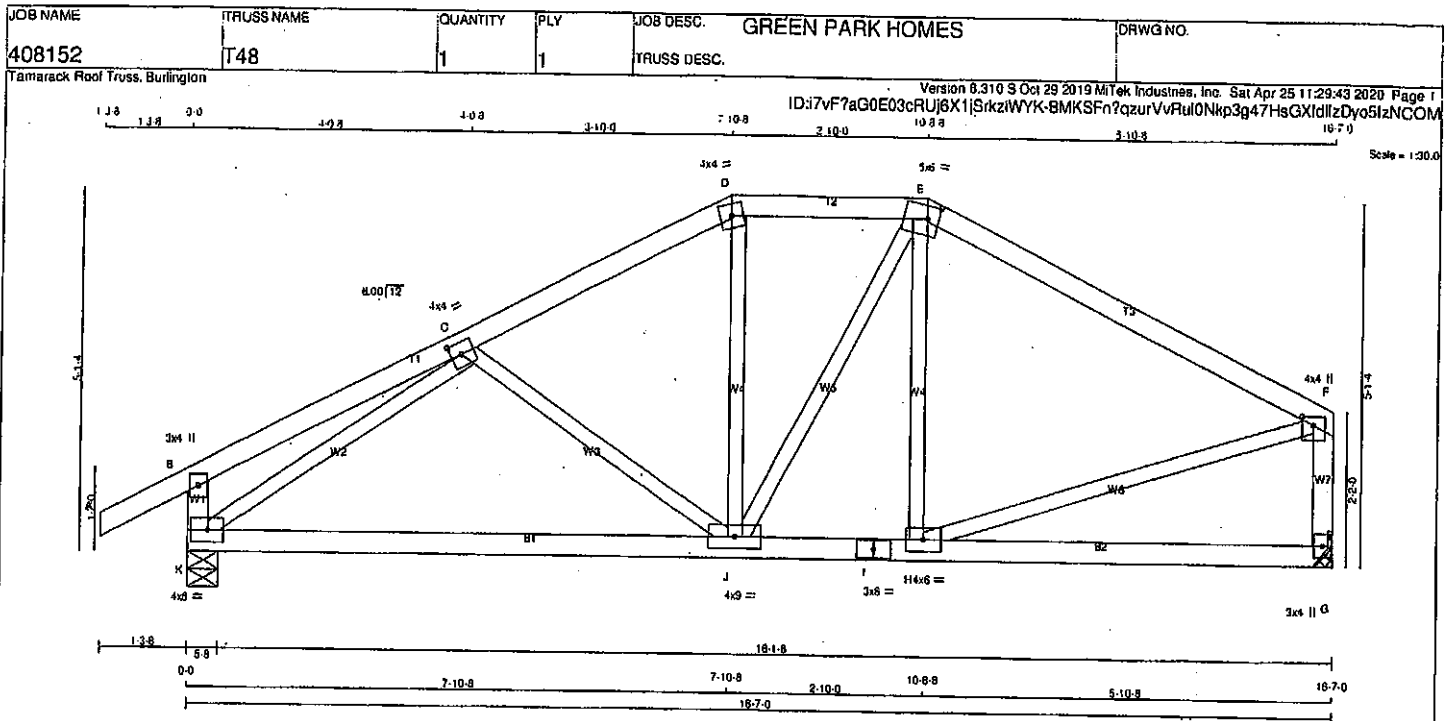

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
F - G	2x4	DRY	No.2	SPF
G - H	2x4	DRY	No.2	SPF
H - I	2x4	DRY	No.2	SPF
I - G	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-i	MT20	4.0	4.0	2.00	1.75
D	TTW-m	MT20	4.0	4.0		
E	TTWW-m	MT20	5.0	8.0	2.25	2.00
F	TMVV+p	MT20	4.0	4.0	1.50	2.00
G	BMV+p	MT20	3.0	4.0		
H	BMWW-i	MT20	4.0	6.0		
I	BS-i	MT20	3.0	6.0		
J	BMWW-i	MT20	4.0	6.0		
K	BMWW-i	MT20	4.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	0	0
K	HORIZ	0	5-8	5-8
G	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN COMPONENT REACTIONS	WIND	DEAD	SOIL
K	COMBINED	494 / 0	0 / 0	238 / 0	0 / 0
G	SNOW	424 / 0	0 / 0	222 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.12 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LENGTH (FT)	MEMB.
FR-TO				FR-TO			
A-B	0 / 28	-91.8	0.12 (1)	10.00	C-J	-232 / 0	0.10 (1)
B-C	0 / 18	-91.8	0.22 (1)	10.00	J-D	0 / 134	0.03 (4)
C-D	-918 / 0	-91.8	0.18 (1)	8.24	J-E	0 / 152	0.03 (1)
D-E	-808 / 0	-91.8	0.10 (1)	8.25	H-E	-183 / 0	0.08 (1)
E-F	-821 / 0	-91.8	0.42 (1)	8.12	K-C	-1221 / 0	0.47 (1)
K-B	-285 / 0	0.0	0.03 (1)	7.01	H-F	0 / 789	0.17 (1)
G-F	-868 / 0	0.0	0.0 (1)	7.81			
K-J	0 / 993	-18.5	-18.5 0.32 (4)	10.00			
J-I	0 / 731	-18.5	-18.5 0.31 (4)	10.00			
I-H	0 / 731	-18.5	-18.5 0.31 (4)	10.00			
H-G	0 / 0	-18.5	-18.5 0.15 (4)	10.00			

TOTAL WEIGHT = 68 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.55")
CALCULATED VERT. DEFL.(LL) = L/889 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.55")
CALCULATED VERT. DEFL.(TL) = L/999 (0.13")

CS: TC=0.42/1.00 (E-F:1), BC=0.32/1.00 (J-K:4), WB=0.47/1.00 (C-K:1), SSI=0.18/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1887 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (C) (INPUT = 0.90)
JSI METAL = 0.41 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007116

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408152	T49	1	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:44 2020 Page 1
ID:7VF7aG0E03cRUj8X1SrkziWYK-/YuqS70SkCzMXbTya4F2buckSGdH15VRCiLdkzNCOU

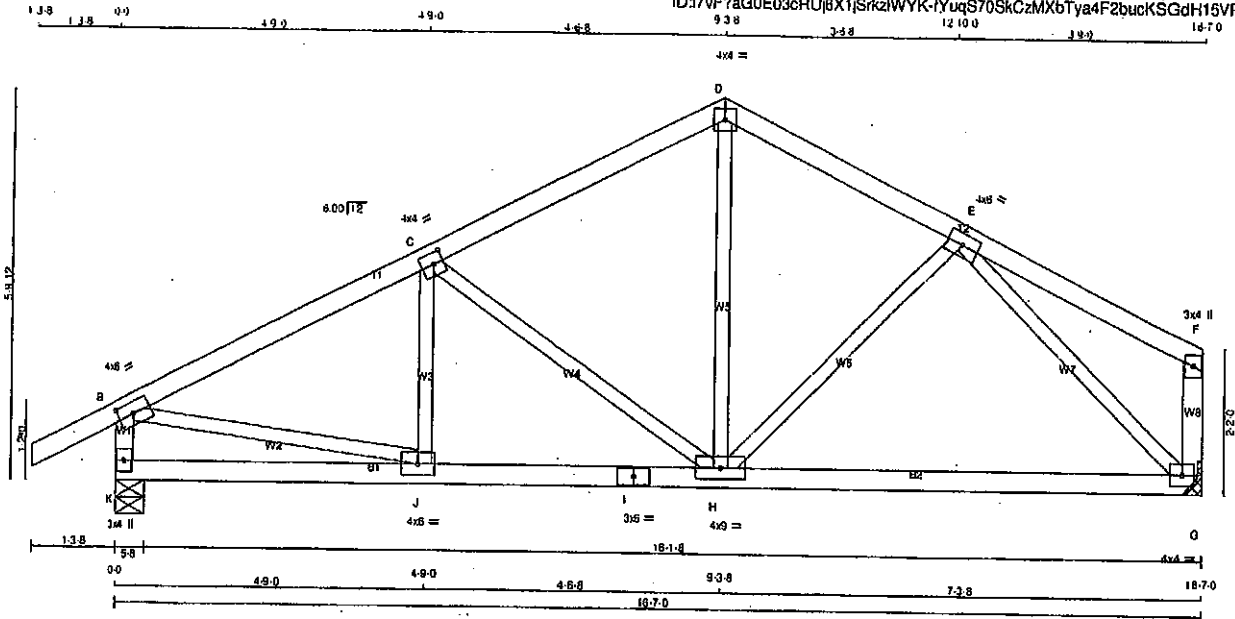

Scale: 3/8\"/>

LUMBER			
N. L. & A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
K - B	2x4	DRY	No.2
G - F	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - G	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-1	MT20	4.0	8.0	2.00 3.00
C	TMVW-1	MT20	4.0	4.0	2.00 1.75
D	TTW-p	MT20	4.0	4.0	
E	TMVW-1	MT20	4.0	6.0	
F	TMV+p	MT20	3.0	4.0	
G	BMVW-1	MT20	4.0	4.0	
H	BMVW-1	MT20	4.0	9.0	
I	BS-1	MT20	3.0	6.0	
J	BMVW-1	MT20	4.0	6.0	
K	BMV-1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	GROSS REACTION	BRG	BRG		
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
K	1039	0	1039	0	0	5-8	5-8
G	914	0	914	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
K	732	494 / 0	0 / 0	0 / 0	0 / 0	238 / 0	0 / 0
G	646	424 / 0	0 / 0	0 / 0	0 / 0	222 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.66 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	J-C	-114 / 23	0.02 (1)
B-C	-1135 / 0	-91.8	-91.8 0.26 (1)	5.66	C-H	-418 / 0	0.22 (1)
C-D	-799 / 0	-91.8	-91.8 0.25 (1)	6.25	H-D	0 / 407	0.09 (1)
D-E	-793 / 0	-91.8	-91.8 0.15 (1)	6.25	H-E	-39 / 37	0.02 (1)
E-F	0 / 17	-91.8	-91.8 0.19 (1)	10.00	B-J	0 / 1061	0.24 (1)
K-B	-988 / 0	0.0	0.0 0.10 (1)	7.81	E-G	-1026 / 0	0.44 (1)
G-F	-129 / 0	0.0	0.0 0.02 (1)	7.81			
K-J	0 / 0	-18.5	-18.5 0.10 (4)	10.00			
J-I	0 / 1034	-18.5	-18.5 0.29 (4)	10.00			
I-H	0 / 1034	-18.5	-18.5 0.29 (4)	10.00			
H-G	0 / 722	-18.5	-18.5 0.26 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F., SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.55")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.65")
CALCULATED VERT. DEFL.(TL) = L/999 (0.10")

CSK TC=0.28/1.00 (B-C:1), BC=0.29/1.00 (H-J:4), WB=0.44/1.00 (E-G:1), SS=0.19/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES						
PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1656


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP = 0.84 (G) (INPUT = 0.90)
JSI METAL = 0.36 (I) (INPUT = 1.00)

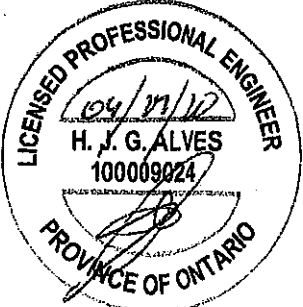

Structural component only
DWG# T-2007117



JSI GRIP= 0.77 (E) (INPUT = 0.90)
JSI METAL= 0.28 (E) (INPUT = 1.00)




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408152	T51	1	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:48 2020 Page 1

ID:7vF?aG0E03eRUj6X1SrkzWYK-cw0bp1jGpD3mvcKIVhJlg13K9V4MkIBBSheznCOJ

Scale = 1:25.4

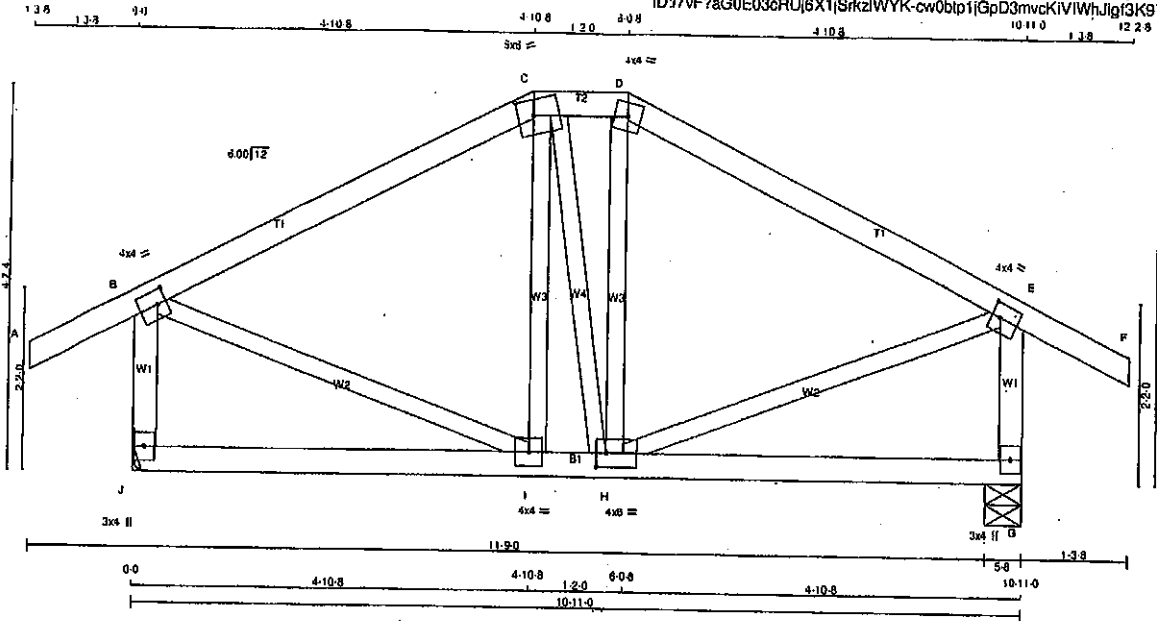

TOTAL WEIGHT = 52 lb (M/F)

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4 DRY	No.2	SPF
C - D	2x4 DRY	No.2	SPF
D - F	2x4 DRY	No.2	SPF
J - B	2x4 DRY	No.2	SPF
G - E	2x4 DRY	No.2	SPF
J - G	2x4 DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT

DRY: SEASONED LUMBER.

PLATES (tablets in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	4.0	2.00 1.25
C	TTWW-m	MT20	5.0	6.0	2.25 2.25
D	TTW-m	MT20	4.0	4.0	
E	TMVW-t	MT20	4.0	4.0	2.00 1.25
G	BMV1+p	MT20	3.0	4.0	
H	BMVWW-1	MT20	4.0	6.0	2.00 1.50
I	BMVWW-t	MT20	4.0	4.0	
J	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	FACTORED	MAXIMUM FACTORED	INPUT	REQD			
	GROSS REACTION	GROSS REACTION	BRG	BRG			
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
J	728	0	728	0	0	MECHANICAL	
G	728	0	728	0	0	5-B	5-B

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 1-8.

UNFACTORED REACTIONS							
JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	511	349 / 0	0 / 0	0 / 0	0 / 0	183 / 0	0 / 0
G	511	349 / 0	0 / 0	0 / 0	0 / 0	183 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	I-C	-78 / 18	0.02 (1)
B-G	-435 / 0	-91.8	-91.8 0.28 (1)	6.25	C-H	-4 / 0	0.00 (1)
C-D	-388 / 0	-91.8	-91.8 0.02 (1)	6.25	H-D	-82 / 19	0.03 (1)
D-E	-434 / 0	-91.8	-91.8 0.28 (1)	6.25	B-I	0 / 415	0.09 (1)
E-F	0 / 28	-91.8	-91.8 0.12 (1)	10.00	H-E	0 / 414	0.09 (1)
J-B	-888 / 0	0.0	0.0 0.08 (1)	7.81			
G-E	-888 / 0	0.0	0.0 0.08 (1)	7.81			
J-I	0 / 0	-18.5	-18.5 0.10 (4)	10.00			
I-H	0 / 367	-18.5	-18.5 0.14 (4)	10.00			
H-G	0 / 0	-18.5	-18.5 0.10 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.36")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.36")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CS: TC=0.28/1.00 (B-C:1), BC=0.14/1.00 (H-I:4), WB=0.08/1.00 (B-I:1), SS=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1887 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.66 (B) (INPUT = 0.90)
JSI METAL = 0.22 (B) (INPUT = 1.00)

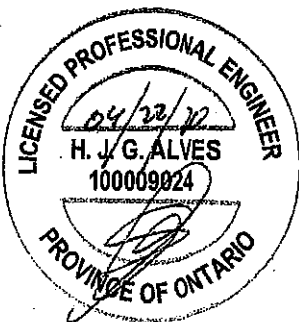

Structural component only
DWG# T-2007119

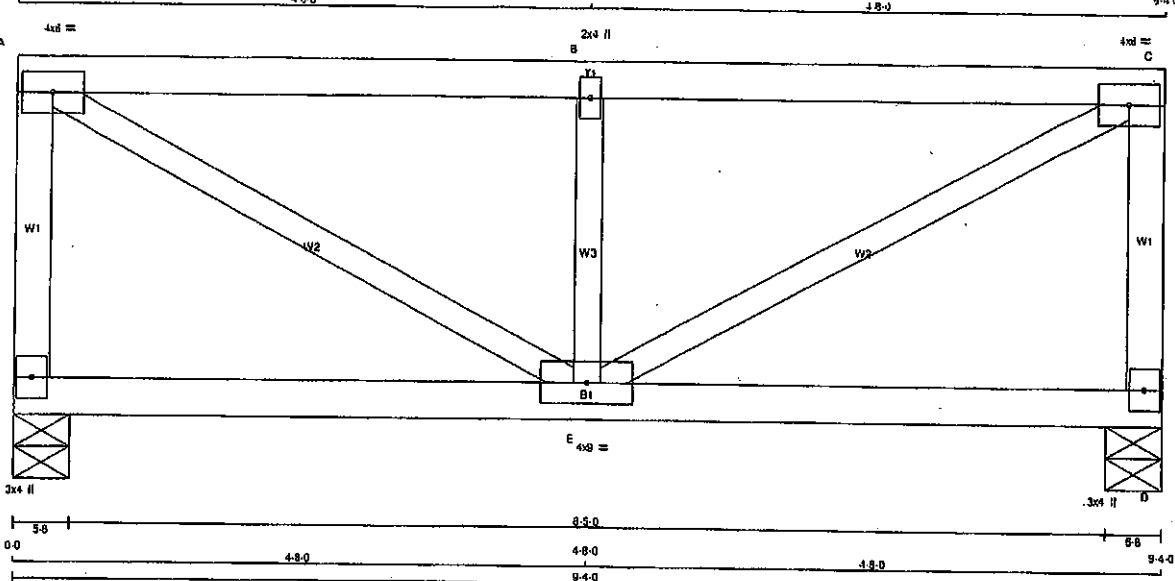

Scale = 1:15.0

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
F - A	2x4	DRY No.2	SPF
A - C	2x4	DRY No.2	SPF
D - C	2x4	DRY No.2	SPF
F - D	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-I	MT20	4.0	8.0		
B	TMVW-w	MT20	2.0	4.0		
C	TMVW-I	MT20	4.0	8.0		
D	BMV1-p	MT20	3.0	4.0		
E	BMVWVW-I	MT20	4.0	9.0		
F	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
F	820	0	820	0	5-8	5-8
D	820	0	820	0	5-8	5-8

UNFACTORED REACTIONS							
JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
		COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
F	448	239 / 0	0 / 0	0 / 0	0 / 0	209 / 0	0 / 0
D	448	239 / 0	0 / 0	0 / 0	0 / 0	209 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, D

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.52 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)		
FR-TO		FROM	TO		FR-TO				
F-A	-583 / 0	0.0	0.0	0.11 (1)	7.81	A-E	0 / 792		
A-B	-695 / 0	-114.3	-114.3	0.55 (1)	6.52	E-B	-695 / 0		
B-C	-885 / 0	-114.3	-114.3	0.55 (1)	6.52	E-C	0 / 792		
D-C	-583 / 0	0.0	0.0	0.11 (1)	7.81				
F-E	0 / 0	-18.5	-18.5	0.13 (4)	10.00				
E-D	0 / 0	-18.5	-18.5	0.13 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 15.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 48.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 8 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.31")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.31")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.55/1.00 (B-C:1), BC=0.13/1.00 (E-F:4), WB=0.24/1.00 (A-E:1), SS=0.34/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX	MIN	MAX
618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.81 (A) (INPUT = 0.90)
JSI METAL = 0.24 (A) (INPUT = 1.00)

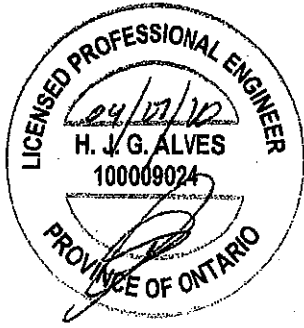

Structural component only
DWG# T-2007120

JOB NAME 408152	TRUSS NAME G52	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:28 2020 Page 1
ID:7vF?aG0E03cRUj6X1jSrkzIWK-7Twn8fpQVHydc8EieJzlyWyePpDiHyU4WOpV3fzNCO6

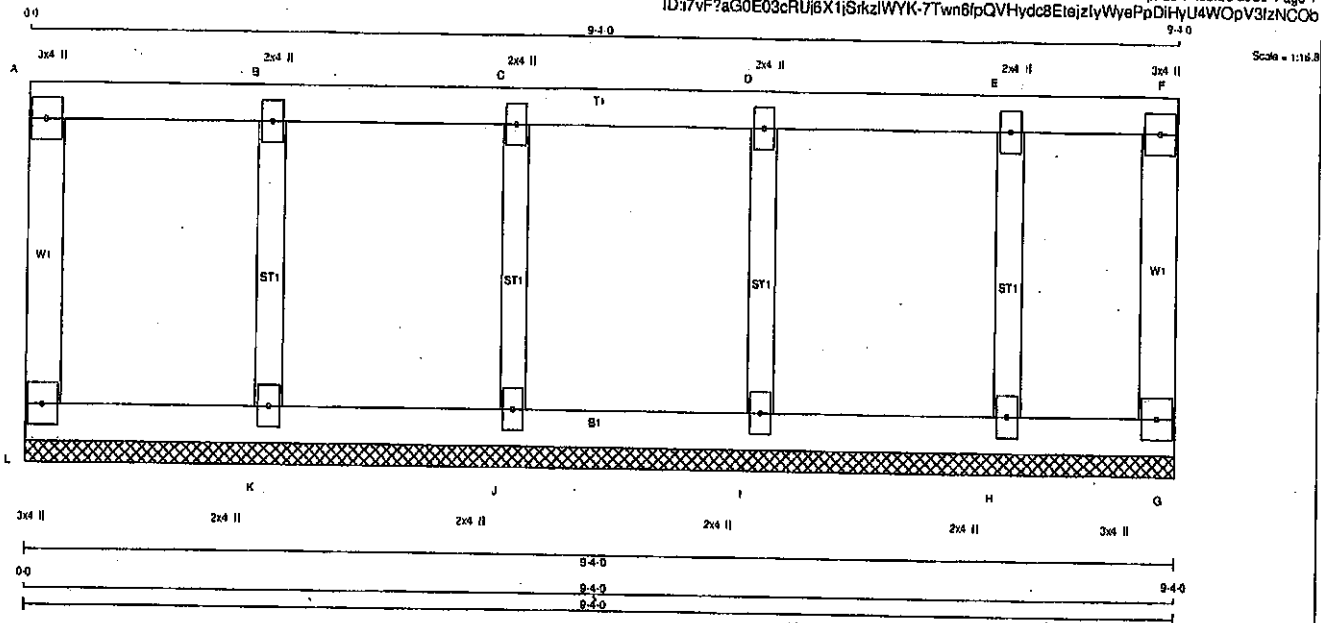

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER
L - A 2x4 DRY No.2
A - F 2x4 DRY No.2
G - F 2x4 DRY No.2
L - G 2x4 DRY No.2
ALL WEBS 2x3 DRY No.2
ALL GABLE WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B, C, D, E						
B	TMV+w	MT20	2.0	4.0		
F	TMV+p	MT20	3.0	4.0		
G	BMV1+p	MT20	3.0	4.0		
H, I, J, K						
H	BMV1+w	MT20	2.0	4.0		
L	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
L-A	-101/0	0.0 0.0	0.03 (1)	K-B	-245/0	0.08 (1)	
A-B	-8/0	-114.3 -114.3	0.08 (1)	J-C	-224/0	0.05 (1)	
B-C	-8/0	-114.3 -114.3	0.08 (1)	I-D	-237/0	0.05 (1)	
C-D	-8/0	-114.3 -114.3	0.07 (1)	H-E	-198/0	0.04 (1)	
D-E	-8/0	-114.3 -114.3	0.07 (1)				
E-F	-8/0	-114.3 -114.3	0.05 (1)				
G-F	-84/0	0.0 0.0	0.02 (1)				
L-K	0/8	-18.5 -18.5	0.02 (4)				
K-J	0/8	-18.5 -18.5	0.02 (4)				
J-I	0/8	-18.5 -18.5	0.02 (4)				
I-H	0/8	-18.5 -18.5	0.02 (4)				
H-G	0/8	-18.5 -18.5	0.02 (1)				

TOTAL WEIGHT = 34 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 15.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 48.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TO=0.08/1.00 (A-B:1), BC=0.02/1.00 (K-L:4), WB=0.08/1.00 (B-K:1), SS=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PL) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (K) (INPUT = 0.90)
JSI METAL= 0.07 (K) (INPUT = 1.00)




Structural component only
DWG# T-2007104

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408152	T53	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Sat Apr 25 11:29:48 2020 Page 1
ID:17vF?aG0E03cRUI6X1ISkzWYK-VJ7LIV3zoQTn?DmjpWk_mkn0t?2zwn17VgZmVzNCOH

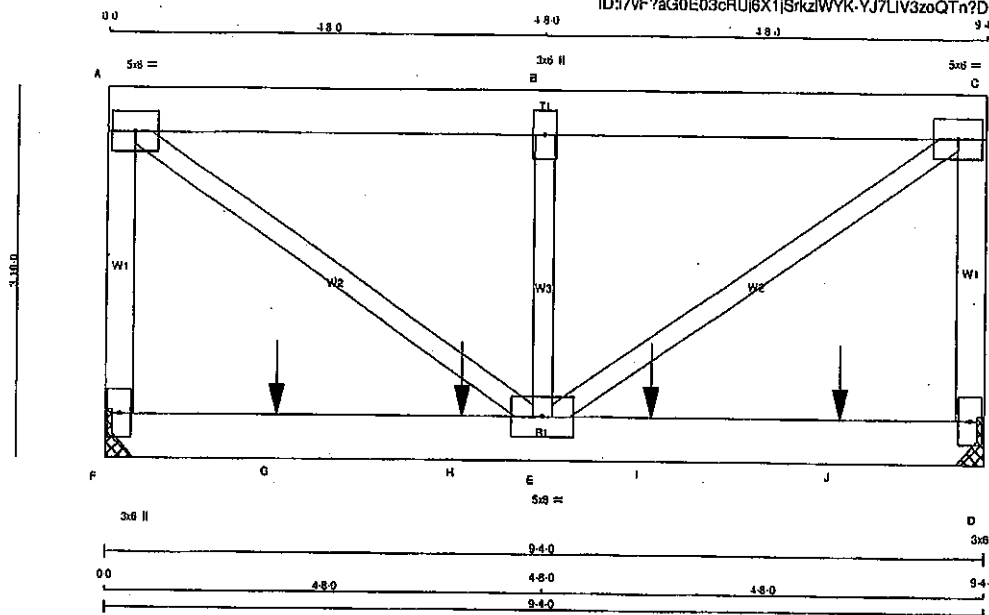

Scale = 1:22.0

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
F - A	2x4	DRY	No.2	SPF		
A - C	2x6	DRY	No.2	SPF		
D - C	2x4	DRY	No.2	SPF		
F - D	2x6	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
DRY: SEASONED LUMBER.						

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
A	TMW+1	MT20	5.0	8.0			
B	TMW+1	MT20	3.0	8.0			
C	TMW+1	MT20	5.0	8.0			
D	BMV+1	MT20	3.0	8.0			
E	BMW+1	MT20	5.0	8.0			
F	BMV+1	MT20	3.0	8.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
F	988	0	988	0
D	1012	0	1012	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F, D. MINIMUM BEARING LENGTH AT JOINT F = 3-8, JOINT D = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	705	427 / 0	0 / 0	0 / 0	0 / 0	279 / 0	0 / 0
D	722	439 / 0	0 / 0	0 / 0	0 / 0	283 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRACED LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH FR-TO	MAX. FACTORED FORCE (LBS)	
FR-TO		FROM TO	CSI (LC)		FR-TO			CSI (LC)	
F-A	-846 / 0	0.0	0.0 0.23 (1)	7.45	A-E	0 / 1072		0.35 (1)	
A-B	-889 / 0	-114.3	-114.3 0.24 (1)	6.25	E-B	-832 / 0		0.18 (1)	
B-C	-889 / 0	-114.3	-114.3 0.24 (1)	6.25	E-C	0 / 1072		0.35 (1)	
D-C	-846 / 0	0.0	0.0 0.23 (1)	7.45					
F-G	0 / 0	-18.5	-18.5 0.24 (1)	10.00					
G-H	0 / 0	-18.5	-18.5 0.24 (1)	10.00					
H-E	0 / 0	-18.5	-18.5 0.24 (1)	10.00					
E-I	0 / 0	-18.5	-18.5 0.24 (1)	10.00					
I-J	0 / 0	-18.5	-18.5 0.24 (1)	10.00					
J-D	0 / 0	-18.5	-18.5 0.24 (1)	10.00					

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	1-9-12	-190	-190	---	FRONT	VERT	TOTAL	---	C1
H	3-9-12	-190	-190	---	FRONT	VERT	TOTAL	---	C1
I	5-9-12	-190	-190	---	FRONT	VERT	TOTAL	---	C1
J	7-9-12	-190	-190	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 15.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 48.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 8, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.31")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.02")
ALLOWABLE DEFL. (TL) = $L/360$ (0.31")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.04")

CSI: TC=0.24/1.00 (B-C:1), BC=0.24/1.00 (D-E:1), WB=0.35/1.00 (A-E:1), SI=0.29/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1667 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.76 (E) (INPUT = 0.90)
JSI METAL = 0.32 (E) (INPUT = 1.00)

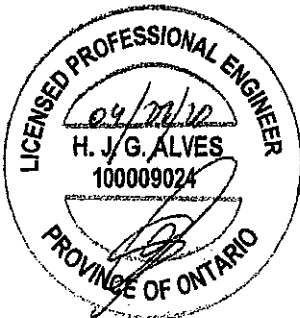


Structural component only
DWG# T-2007121

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408152	T54	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:50 2020 Page 1
ID:17vF7aG0E03cRUj6X1jSkzIWYK-Uif5jA4DJ2jVFWw6xLMSr9sN4hadRnVJap9frOzNCOF

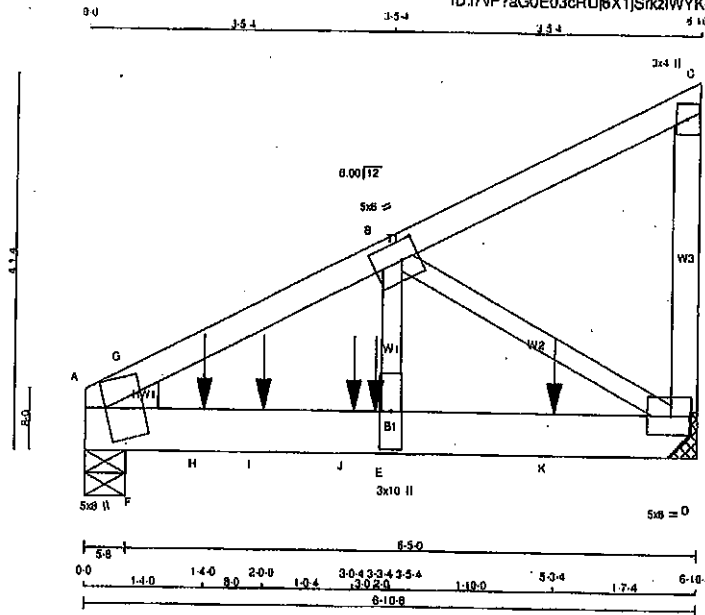

Scale = 1/2" = 1'-0"

LUMBER	N.L.G.A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF		
D - C	2x4 DRY	No.2	SPF		
A - D	2x6 DRY	No.2	SPF		
ALL WEBS	2x3 DRY	No.2	SPF		
DRY: SEASONED LUMBER.					

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 1	12	TOP
C - D 1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
A - D 2	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TBMH1+m	MT20	5.0	8.0	3.50	
B	TMVW-t	MT20	5.0	6.0	2.50	2.25
C	TMV+p	MT20	3.0	4.0		
D	BMVW1-t	MT20	5.0	8.0	2.50	2.75
E	BMV+w	MT20	3.0	10.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD	HEEL
JT	GROSS REACTION	GROSS REACTION	BRG	BRG	WEDGE
A	VERT	DOWN	0	0	2x4 L
D	HORIZ	UP/LIFT	5-8	5-8	
			MECHANICAL		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4'-0".

UNFACTORED REACTIONS

JT	1ST LOOSE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	COMBINED		1822 / 0	0 / 0	0 / 0	0 / 0	828 / 0	0 / 0
D			1144 / 0	0 / 0	0 / 0	0 / 0	591 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.16 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MEMB.	FORCE (LBS)
FR-TO			FR-TO	
A-G	-4978 / 0	-91.8 -91.8 0.19 (1)	E-B	0 / 3385
G-B	-3863 / 0	-91.8 -91.8 0.17 (1)	B-D	-4035 / 0
B-C	-13 / 0	-91.8 -91.8 0.07 (1)	F-G	0 / 1740
O-C	-129 / 0	0.0 0.0 0.02 (1)		
A-F	0 / 3490	-18.5 -18.5 0.25 (1)		
F-H	0 / 3490	-18.5 -18.5 0.88 (1)		
H-I	0 / 3490	-18.5 -18.5 0.88 (1)		
I-J	0 / 3490	-18.5 -18.5 0.88 (1)		
J-E	0 / 3490	-18.5 -18.5 0.88 (1)		
E-K	0 / 3490	-18.5 -18.5 0.49 (1)		
K-D	0 / 3490	-18.5 -18.5 0.49 (1)		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
H	1-4-0	-1378	-1378	---	BACK	VERT	TOTAL	---	C1
I	2-0-0	-1000	-1000	---	FRONT	VERT	TOTAL	---	C1
J	3-0-4	-894	-894	---	FRONT	VERT	TOTAL	---	C1
J	3-3-4	-898	-898	---	BACK	VERT	TOTAL	---	C1
K	5-3-4	-898	-898	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 30 = 60 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD = 39.0 PSF	

SPACING = 24.0 IN. C/C

*** NON STANDARD GIRDER ***

ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIG 2011, TPIG 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.23")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL) = L/880 (0.23")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.19/1.00 (A-G:1), BC=0.88/1.00 (E-F:1), WB=0.53/1.00 (B-D:1), SS=0.90/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PLJ)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1907 1668

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (B) (INPUT = 0.90)
JSI METAL= 0.70 (A) (INPUT = 1.00)




Structural component only
DWG# T-2007122

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408150	G60	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 11:02:39 2020 Page 1
ID:17vF7aG0E03cRUj6X1SikzIWK-kwCWPUL9QwEw4kaulc_ECpgnD4MnCBFXZZr4QzNCnk

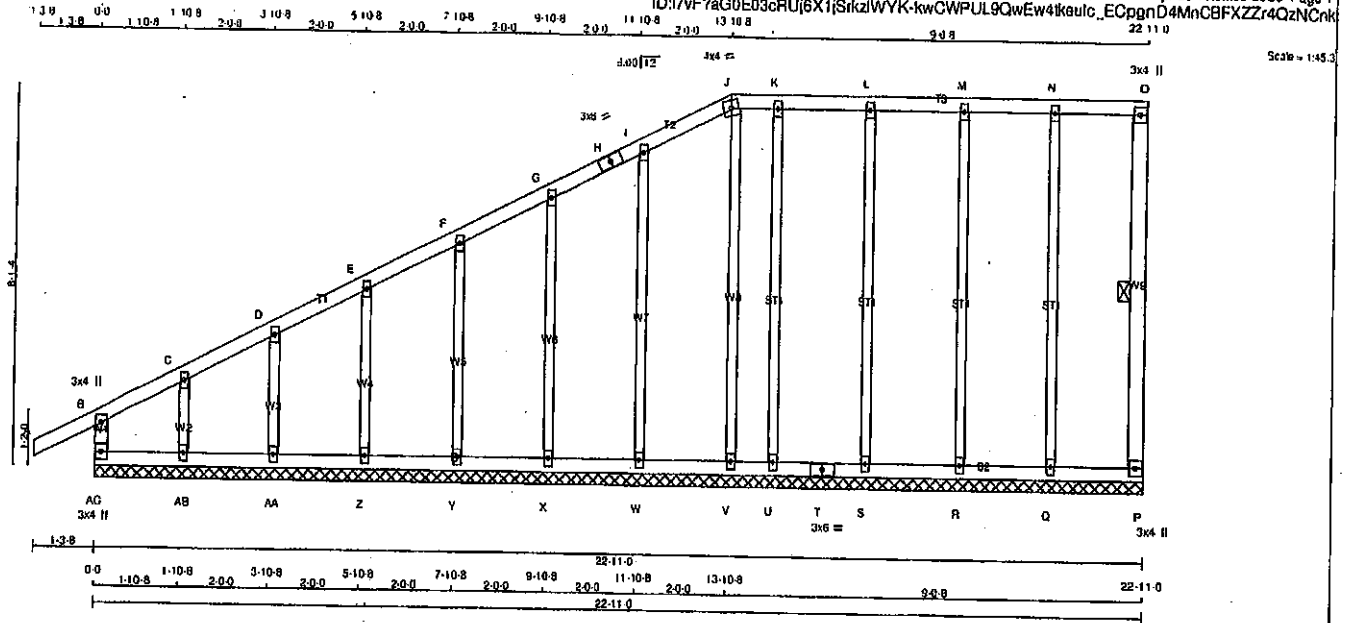

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS	2x4	DRY	No.2
AC-B	2x4	DRY	No.2
A-H	2x4	DRY	No.2
H-J	2x4	DRY	No.2
J-O	2x4	DRY	No.2
P-O	2x4	DRY	No.2
AC-T	2x4	DRY	No.2
T-P	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			
GABLE STUDS SPACED AT 2-0-0 OC.			

PLATES (table is in inches)			
JT TYPE	PLATES	W	LEN Y X
B TMV+p	MT20	3.0	4.0
C, D, E, F, G, I, K, L, M, N	MT20	2.0	4.0
H TS+	MT20	3.0	8.0
J TTW-m	MT20	4.0	4.0
O TMV+p	MT20	3.0	4.0
P BMV+p	MT20	3.0	4.0
Q, R, S, U, V, W, X, Y, Z, AA, AB	MT20	2.0	4.0
Q BMV+w	MT20	3.0	8.0
T BS+	MT20	3.0	8.0
AC BMV+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF O.P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING			
TOTAL LOAD CASES: (4)			
CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)
FR-TO			
AC-B	-224/0	0.0	0.02 (1)
A-B	0/28	-91.8	-91.8 0.12 (1)
B-C	-28/0	-91.8	-91.8 0.04 (1)
C-D	-19/0	-91.8	-91.8 0.04 (1)
D-E	-15/0	-91.8	-91.8 0.04 (1)
E-F	-11/0	-91.8	-91.8 0.04 (1)
F-G	-8/0	-91.8	-91.8 0.04 (1)
G-H	-6/0	-91.8	-91.8 0.04 (1)
H-I	-6/0	-91.8	-91.8 0.04 (1)
I-J	-6/0	-91.8	-91.8 0.04 (1)
J-K	-2/0	-91.8	-91.8 0.03 (1)
K-L	-2/0	-91.8	-91.8 0.04 (1)
L-M	-2/0	-91.8	-91.8 0.04 (1)
M-N	-2/0	-91.8	-91.8 0.04 (1)
N-O	-2/0	-91.8	-91.8 0.04 (1)
P-O	-81/0	0.0	0.0 0.01 (1)
WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)
FR-TO			
Q-N	-195/0	7.81	0.25 (1)
R-M	-193/0	7.81	0.23 (1)
S-L	-188/0	7.81	0.24 (1)
U-K	-136/0	7.81	0.17 (1)
V-J	-131/0	7.81	0.17 (1)
W-I	-165/0	7.81	0.17 (1)
X-G	-183/0	7.81	0.11 (1)
Y-F	-182/0	7.81	0.07 (1)
Z-E	-182/0	7.81	0.05 (1)
AA-D	-183/0	7.81	0.03 (1)
AB-C	-176/0	7.81	0.03 (1)

TOTAL WEIGHT = 4 X 116 = 464 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.0/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (Q-R:4), WB=0.25/1.00 (N-Q:1), SS=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.60 (INPUT = 0.90)
JSI METAL= 0.08 (INPUT = 1.00)

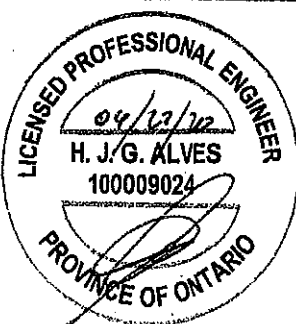

Structural component only
DWG# T-2007057

JOB NAME 408150	TRUSS NAME GP1	QUANTITY 2	PLV 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 5 Oct 2019 Mittek Industries, Inc. Sat Apr 25 11:02:40 2020 Page 1 IDj7vF7aG0E03cRUj6X1iSrkzWYK-C8mudqMnBDMnh0JqS07DnQMnicNpWgWomDIPdszNCn		

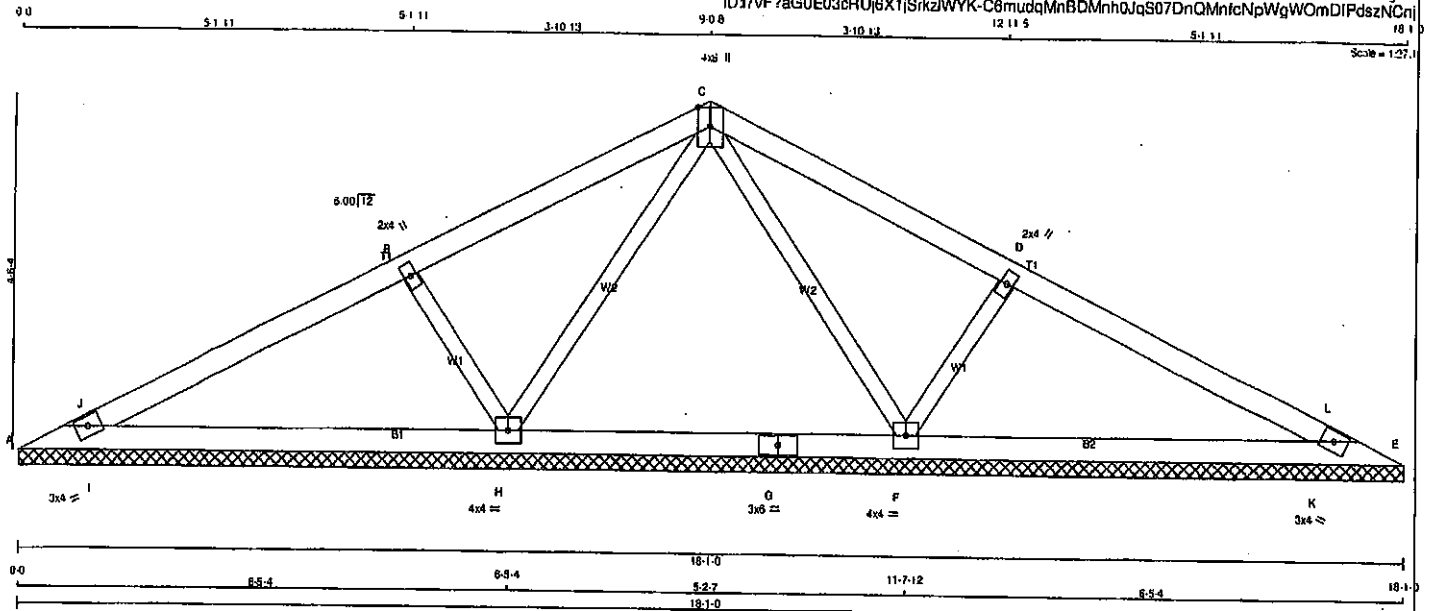

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
A - G	2x4	DRY	No.2
G - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TBM1-h	MT20	3.0	4.0	
B	TBM1-w	MT20	2.0	4.0	
C	TTWW-p	MT20	4.0	8.0	Edge
D	TBM1-w	MT20	2.0	4.0	
E	TBM1-h	MT20	3.0	4.0	
F	BMWW1-t	MT20	4.0	4.0	
G	BS-t	MT20	3.0	6.0	
H	BMWW1-t	MT20	4.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
A	134	0	134	0	0	18-1-0 (9-11-103)-0	
E	134	0	134	0	0	18-1-0 (9-11-103)-0	
F	863	0	863	0	0	18-1-0 (9-11-103)-0	
H	863	0	863	0	0	18-1-0 (9-11-103)-0	

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
A	94	68 / 0	0 / 0	0 / 0	0 / 0	28 / 0	0 / 0
E	94	68 / 0	0 / 0	0 / 0	0 / 0	28 / 0	0 / 0
F	811	395 / 0	0 / 0	0 / 0	0 / 0	218 / 0	0 / 0
H	811	395 / 0	0 / 0	0 / 0	0 / 0	218 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, F, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-J	0 / 240	-91.8 -91.8	0.12 (1)	10.00	C-F	-428 / 0	0.18 (1)
J-B	0 / 301	-91.8 -91.8	0.34 (1)	10.00	F-D	-438 / 0	0.08 (1)
B-C	0 / 503	-91.8 -91.8	0.37 (1)	10.00	H-C	-428 / 0	0.18 (1)
C-D	0 / 503	-91.8 -91.8	0.37 (1)	10.00	B-H	-438 / 0	0.08 (1)
D-L	0 / 301	-91.8 -91.8	0.34 (1)	10.00	I-J	-76 / 35	0.00 (1)
L-E	0 / 240	-91.8 -91.8	0.12 (1)	10.00	K-L	-76 / 35	0.00 (1)
A-I	-258 / 0	-18.5 -18.5	0.11 (1)	6.25			
I-H	-243 / 0	-18.5 -18.5	0.13 (4)	6.25			
H-G	-246 / 0	-18.5 -18.5	0.13 (4)	6.25			
G-F	-246 / 0	-18.5 -18.5	0.13 (4)	6.25			
F-K	-243 / 0	-18.5 -18.5	0.13 (4)	6.25			
K-E	-255 / 0	-18.5 -18.5	0.11 (1)	6.25			

TOTAL WEIGHT = 2 X 54 = 107 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.37/1.00 (C-D:1), BC=0.13/1.00 (F-K:4),
WB=0.18/1.00 (C-H:1), SS=0.17/1.00 (D-L:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.48 (H) (INPUT = 0.80)
JSI METAL = 0.15 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007058

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408150	P1	17	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MYtek Industries, Inc. Sat Apr 25 11:02:45 2020 Page 1
ID:17vF7aG0E03cRUj8X1jSkzWYK-Z4ZngXQw0m_400BoEZjOUT3e9d5nBxS8vV0A14zNCn9

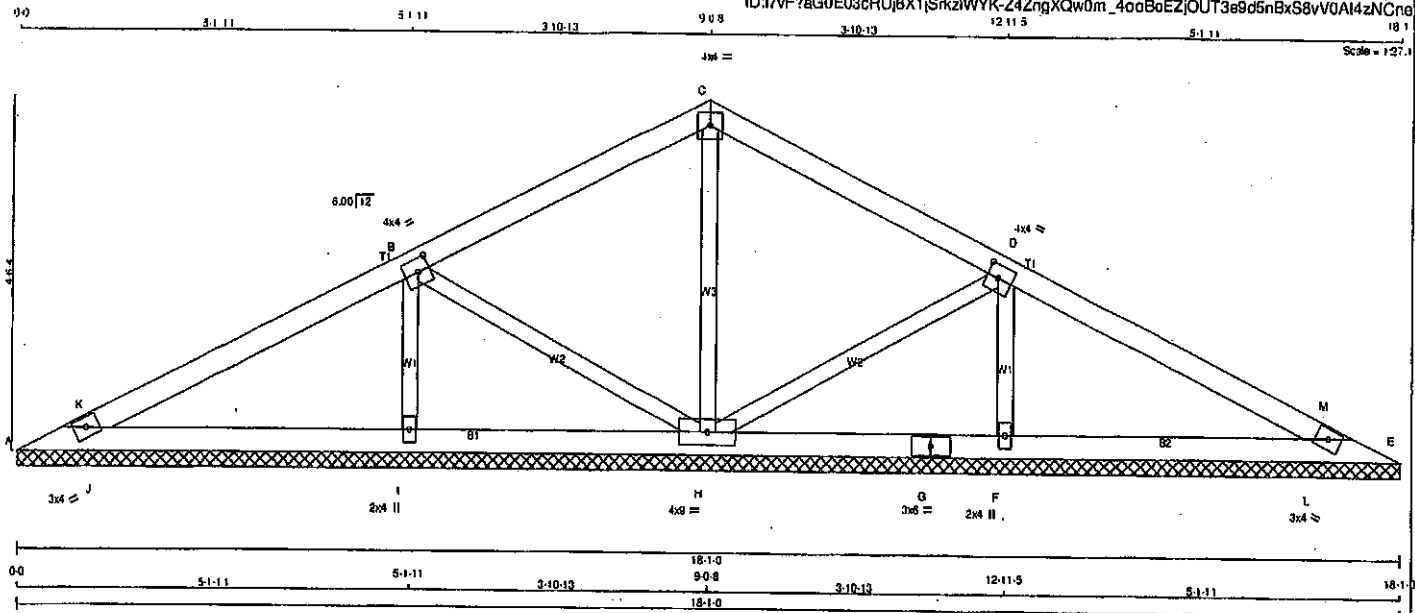

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
A - G	2x4	DRY	No.2
G - E	2x4	DRY	No.2
ALL WEBS		2x3	DRY
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TBM1-h	MT20	3.0	4.0
B	TBMW1-h	MT20	4.0	4.0
C	TTW-p	MT20	4.0	4.0
D	TBMW1-h	MT20	4.0	4.0
E	TBM1-h	MT20	3.0	4.0
F	BMW1-h	MT20	3.0	4.0
G	BS-1	MT20	3.0	4.0
H	BMW1-h	MT20	4.0	9.0
I	BMW1-h	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
A	124	0	124	0	0	18-1-0 (11-1112) 0	
E	124	0	124	0	0	18-1-0 (11-1112) 0	
H	415	0	415	0	0	18-1-0 (11-1112) 0	
F	668	0	668	0	0	18-1-0 (11-1112) 0	
I	668	0	668	0	0	18-1-0 (11-1112) 0	

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	87	59/0	0/0	0/0	0/0	28/0	0/0
E	87	59/0	0/0	0/0	0/0	28/0	0/0
H	293	192/0	0/0	0/0	0/0	101/0	0/0
F	471	307/0	0/0	0/0	0/0	164/0	0/0
I	471	307/0	0/0	0/0	0/0	164/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, H, F, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC	MEMB.	FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO		LENGTH	FR-TO		
A-K	0/248	-91.8	-91.8 0.07 (1)	10.00	H-C	-445/0	0.13 (1)
K-B	0/292	-91.8	-91.8 0.32 (1)	10.00	H-D	0/59	0.01 (1)
B-C	0/188	-91.8	-91.8 0.30 (1)	10.00	F-D	-528/0	0.08 (1)
C-D	0/188	-91.8	-91.8 0.30 (1)	10.00	B-H	0/59	0.01 (1)
D-M	0/292	-91.8	-91.8 0.32 (1)	10.00	I-B	-528/0	0.08 (1)
M-E	0/248	-91.8	-91.8 0.07 (1)	10.00	J-K	-128/6	0.06 (1)
					L-M	-128/6	0.06 (1)
A-J	-256/0	-18.5	-18.5 0.14 (1)	6.25			
J-I	-240/0	-18.5	-18.5 0.14 (1)	6.25			
I-H	-240/0	-18.5	-18.5 0.11 (1)	6.25			
H-G	-240/0	-18.5	-18.5 0.11 (1)	6.25			
G-F	-240/0	-18.5	-18.5 0.11 (1)	6.25			
F-L	-240/0	-18.5	-18.5 0.14 (1)	6.25			
L-E	-258/0	-18.5	-18.5 0.14 (1)	6.25			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2010
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.32/1.00 (D-M:1), BC=0.14/1.00 (F-L:1),
WB=0.13/1.00 (C-H:1), SS=0.17/1.00 (D-M:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.51 (B) (INPUT = 0.80)
JSI METAL= 0.13 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007062

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408151	PB20	2	1	TRUSS DESC.		

Tamareck Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:19:42 2020 Page 1
ID:h2dflgC44wS_E2lqPs_atzIRw-HkWF6HjVE7m4RFJfSiCshPKbCR_v_qmDlUdZNCXl

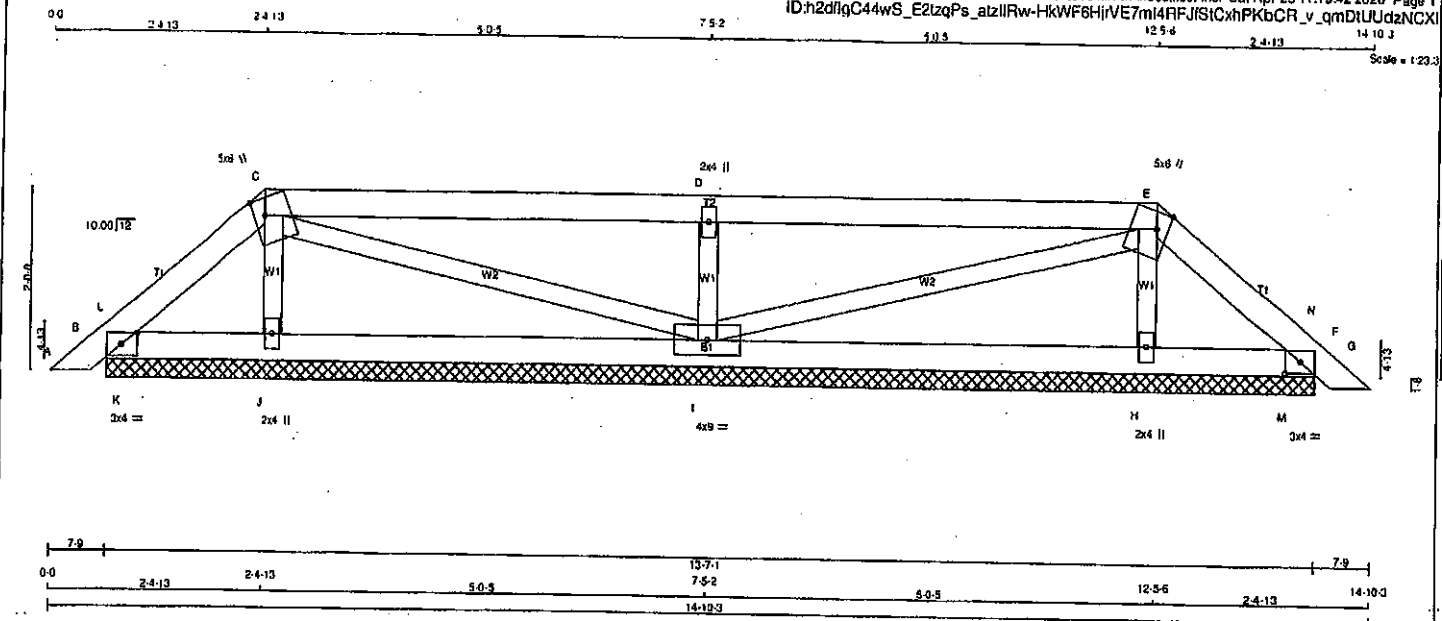

LUMBER				DESCR.	
N.L.G.A. RULES	SIZE	LUMBER		SPF	
CHORDS					
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
E - G	2x4	DRY	No.2	SPF	
B - F	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMB1-I	MT20	3.0	4.0	1.50 2.00
C	TTWW+m	MT20	5.0	6.0	2.25 1.50
D	TWW+m	MT20	2.0	4.0	
E	TTWW+m	MT20	5.0	6.0	2.25 1.50
F	TMB1-I	MT20	3.0	4.0	1.50 2.00
H	BMW1+w	MT20	2.0	4.0	
I	BMWW1-I	MT20	4.0	9.0	
J	BMW1+w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
B	169	0	169	0	13-7-1	13-7-1
F	169	0	169	0	13-7-1	13-7-1
J	288	0	288	0	13-7-1	13-7-1
I	683	0	683	0	13-7-1	13-7-1
H	288	0	288	0	13-7-1	13-7-1

UNFACTORED REACTIONS

JT	COMBINED	1ST CASE		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
		SNOW	LIVE	PERM	LIVE			
B	116	93/0	0/0	0/0	0/0	23/0	0/0	0/0
F	116	93/0	0/0	0/0	0/0	23/0	0/0	0/0
J	207	118/0	0/0	0/0	0/0	89/0	0/0	0/0
I	481	327/0	0/0	0/0	0/0	154/0	0/0	0/0
H	207	118/0	0/0	0/0	0/0	89/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, F, J, I, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD		MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
		FROM	TO					
A-B	0/14	-91.8	-91.8	0.02 (1)	10.00	J-C	-194/0	0.03 (1)
B-L	-31/4	-91.8	-91.8	0.01 (1)	6.25	C-I	-22/0	0.01 (1)
L-C	-60/0	-91.8	-91.8	0.03 (1)	6.25	I-D	-578/0	0.08 (1)
C-D	-8/0	-91.8	-91.8	0.39 (1)	10.00	D-E	-22/0	0.01 (1)
D-E	-8/0	-91.8	-91.8	0.39 (1)	10.00	E-N	-194/0	0.03 (1)
E-N	-60/0	-91.8	-91.8	0.03 (1)	6.25	K-L	-121/0	0.00 (1)
N-F	-31/4	-91.8	-91.8	0.01 (1)	6.25	M-N	-121/0	0.00 (1)
F-G	0/14	-91.8	-91.8	0.02 (1)	10.00			
B-K	0/42	-18.5	-18.5	0.04 (1)	10.00			
K-J	0/42	-18.5	-18.5	0.07 (4)	10.00			
J-I	0/29	-18.5	-18.5	0.10 (4)	10.00			
I-H	0/29	-18.5	-18.5	0.10 (4)	10.00			
H-M	0/42	-18.5	-18.5	0.07 (4)	10.00			
M-F	0/42	-18.5	-18.5	0.04 (1)	10.00			

TOTAL WEIGHT = 2 X 45 = 90 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCO 2010, NBCO 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.39/1.00 (C-D:1), BC=0.10/1.00 (I-J:4), WB=0.09/1.00 (D-I:1), SSI=0.22/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.30 (D) (INPUT = 0.90)
JSI METAL = 0.12 (D) (INPUT = 1.00)




Structural component only
DWG# T-2007080

JOB NAME 408150	TRUSS NAME J1	QUANTITY 21	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	------------------	----------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:02:42 2020 Page 1
ID:7vF?aG0E03cRUj6X1jSkzWYK-9Vrf1WN1jrcVxKTDZ9hrR4TQ3l_cmhDXnWhlzNCnh

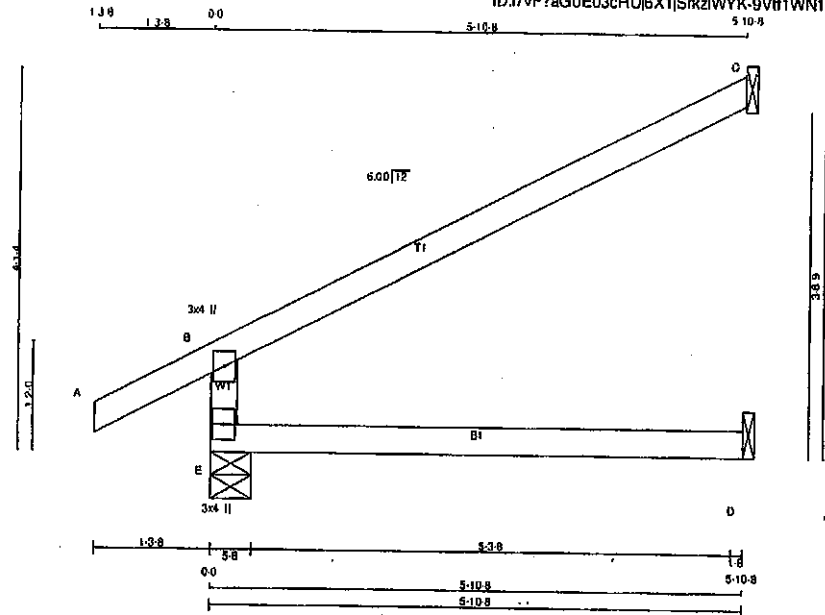

Scale = 1/22.5

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)			
JT TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0 4.0
E	BMV1+p	MT20	3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	JT	DOWN	UPLIFT	IN-SX	IN-SX	
E	525	0	525	0	5-8	5-8	
C	202	0	202	0	1-8	1-8	
D	45	0	50	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST CASE		MAX/MIN. COMPONENT REACTIONS		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	JT	COMBINED	SNOW	LIVE
E	389	257 / 0	0 / 0	0 / 0	0 / 0	111 / 0	0 / 0	E	389	257 / 0	0 / 0
C	139	113 / 0	0 / 0	0 / 0	0 / 0	28 / 0	0 / 0	C	139	113 / 0	0 / 0
D	38	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0	D	38	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	LCI MAX	MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	LCI MAX
FR-TO		FROM TO		FR-TO		FROM TO	
E-B	-461 / 0	0.0	0.0 0.13 (4)	7.81			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00			
B-C	-30 / 0	-91.8	-91.8 0.54 (1)	6.25			
E-D	0 / 0	-18.5	-18.5 0.13 (4)	10.00			

TOTAL WEIGHT = 21 X 17 = 353 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 085-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.03")

CSI: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4),
WB=0.00/1.00 (A-B:0), SS=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1657 788 1937 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.19 (E) (INPUT = 0.90)
JSI METAL = 0.13 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007059

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 11:02:44 2020 Page 1
ID:17vF?aG0E03cRUj6X1jSrk2WYK-5u?PSBPIFSSDAedbh9B9xGWUuEIBSWG hrGcmdzNCnf

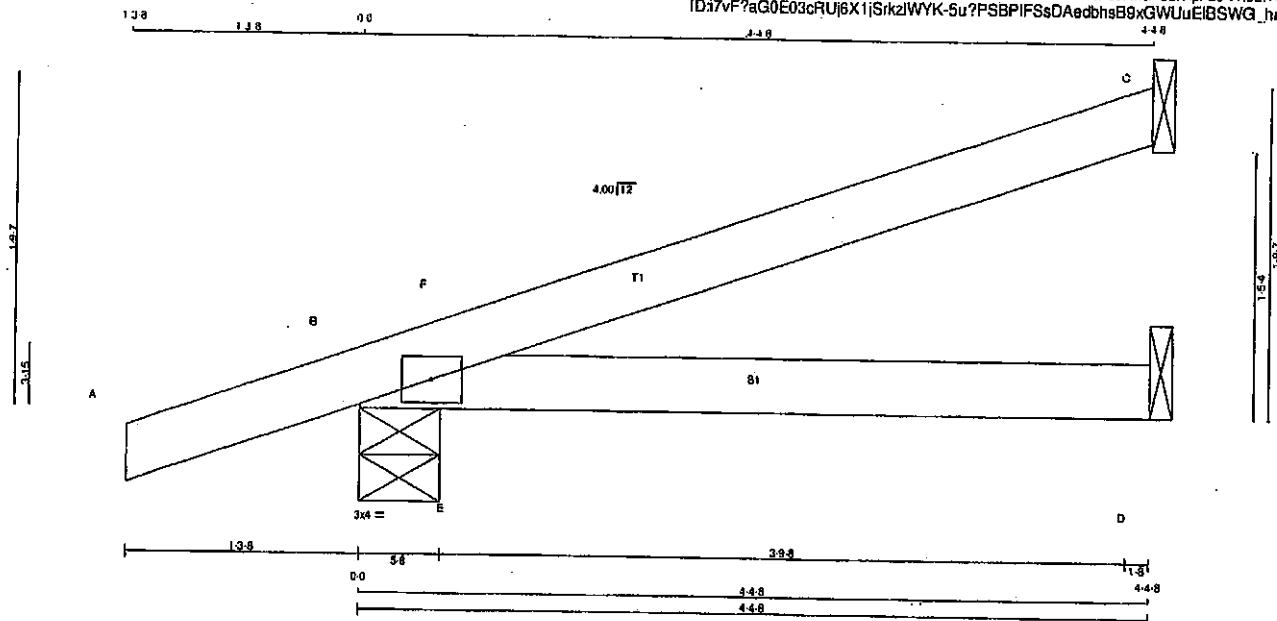

TOTAL WEIGHT = 6 X 12 = 71 lb

N. L. G. A. RULES			
CHORDS	SIZE		LUMBER
A - C	2x4	DRY	No.2
B - D	2x4	DRY	No.2

DRY: SEASONED LUMBER

JT	TYPE	PLATES	W	LEN	Y	X
B	TM81-H	MT20	3.0	4.0		

BEARINGS

	FACTORED		MAXIMUM FACTORED			INPUT	REQD
	GROSS REACTION		GROSS REACTION			BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
C	174	0	174	0	0	1-8	1-8
B	384	0	364	0	0	5-8	5-8
D	88	0	88	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C . D

1ST LOASE MAX. MIN. COMPONENT REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
C	120	93/0	0/0	0/0	0/0	27/0	0/0
B	255	180/0	0/0	0/0	0/0	75/0	0/0
D	50	19/0	0/0	0/0	0/0	32/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B. D

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LG1 (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0/18	-91.8	-91.8	0.11 (1)	10.00	E-F	-194/7
B-F	-14/0	-91.8	-91.8	0.05 (4)	8.25		0.00 (1)
F-C	0/2	-91.8	-91.8	0.22 (1)	10.00		
B-E	0/0	-18.5	-18.5	0.17 (1)	10.00		
E-D	0/0	-18.5	-18.5	0.17 (1)	10.00		

SPECIFIED LOADS:			
TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD =		39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.02")
ALLOWABLE DEFL.(TL)= $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.05")

CSI: TC=0.22/1.00 (C-F:1), BC=0.17/1.00 (D-E:1),
WB=0.00/1.00 (E-F:1), SS=0.16/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.24 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007061

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	J40	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:29 2020 Page 1
ID:7vF?aG0E03cRUj6X1jSrkzWYK-bfU9J?q2Gb4UDip3CRUXVjVnrDY50PbEi2Z2b6zNCOa

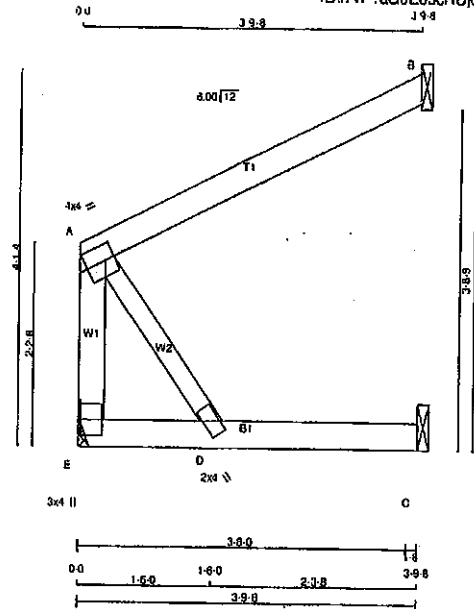

Scale = 1/32"

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - A	2x4	DRY	No.2	SPF
A - B	2x4	DRY	No.2	SPF
E - C	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW-t	MT20	4.0	4.0	2.00 1.25
D	BMW+u	MT20	2.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	VERT	HORZ	FACTORED		MAXIMUM FACTORED		INPUT	REQD
			GROSS REACTION	DOWN	GROSS REACTION	UP	BRG	BRG
E	209	0	209	0	0	0	IN-SX	IN-SX
B	174	0	174	0	0	0	MECHANICAL	
C	35	0	39	0	0	0	1-8	1-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
E	148	97 / 0	0 / 0	0 / 0	51 / 0	0 / 0
B	120	97 / 0	0 / 0	0 / 0	23 / 0	0 / 0
C	28	0 / 0	0 / 0	0 / 0	28 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	LC2 MAX	UNBRAC LENGTH	FR-TO	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
E-A		-174 / 0	0.0	0.0	0.02 (1)	7.81	A-D	0 / 0		0.00 (1)	
A-B		0 / 0	-91.8	-91.8	0.22 (1)	10.00					
E-D		0 / 0	-18.5	-18.5	0.07 (4)	10.00					
D-C		0 / 0	-18.5	-18.5	0.08 (4)	10.00					

TOTAL WEIGHT = 4 X 13 = 52 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.01")

CSI: TC=0.22/1.00 (A-B:1), BC=0.08/1.00 (C-D:4), WB=0.00/1.00 (A-D:1), SSI=0.12/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.11 (A) (INPUT = 0.90)
JSI METAL = 0.03 (A) (INPUT = 1.00)




Structural component only
DWG# T-2007105

JOB NAME 408152	TRUSS NAME J41	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	ORWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:31 2020 Page 1
ID:7vF?aG0E03cRUj6X1jSkzWYK-Y2cwkhRJoCKCTbzSJsX?a8a7q0FFUJ5WDM28q_zNGOY

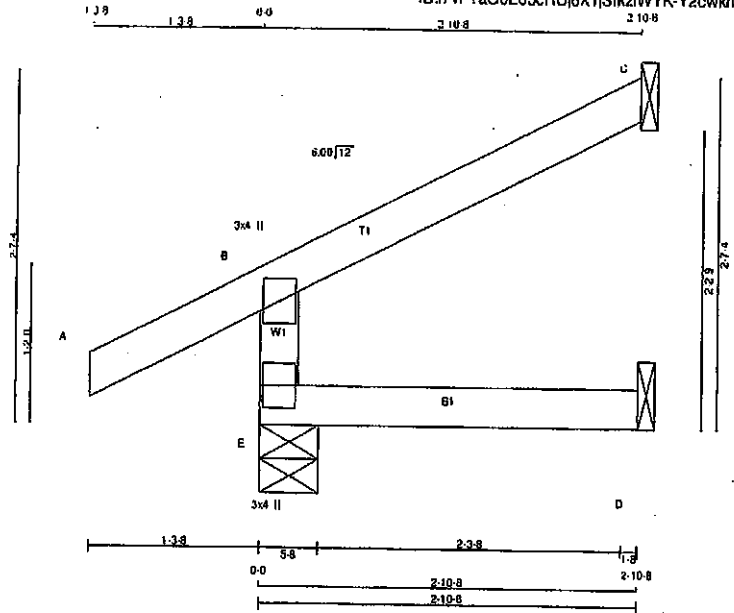

Scale = 1/16" = 1'-0"

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
E - B	2x4 DRY	No.2	SPF
A - C	2x4 DRY	No.2	SPF
E - D	2x4 DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMV+p	MT20	3.0	4.0	
E BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT		REQD	
JT	VERT	JT	DOWN	BRG	IN-SX	BRG	IN-SX
E	319	0	319	0	5-8	5-8	
C	89	0	89	0	1-8	1-8	
D	23	0	23	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST CASE		MAX/MIN COMPONENT REACTIONS		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	COMBINED	SNOW	LIVE	PERM. LIVE
E	223	161 / 0	0 / 0	0 / 0	0 / 0	62 / 0	0 / 0				
C	68	55 / 0	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0				
D	18	0 / 0	0 / 0	0 / 0	0 / 0	18 / 0	0 / 0				

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	LENGTH	FR-TO
E-B	-289 / 0	0.0	0.0	0.02 (4)	7.81
A-B	0 / 28	-91.8	-91.8	0.13 (5)	10.00
B-C	-15 / 0	-91.8	-91.8	0.13 (1)	6.25
E-D	0 / 0	-18.5	-18.5	0.03 (4)	10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 4 X 10 = 38 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/998$ (0.00")

CSI: TC=0.13/1.00 (B-C-1), BC=0.03/1.00 (D-E-4), WB=0.00/1.00 (n/a), SSI=0.11/1.00 (B-C-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.12 (E) (INPUT = 0.90)
JSI METAL = 0.08 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007106

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408150	C1	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

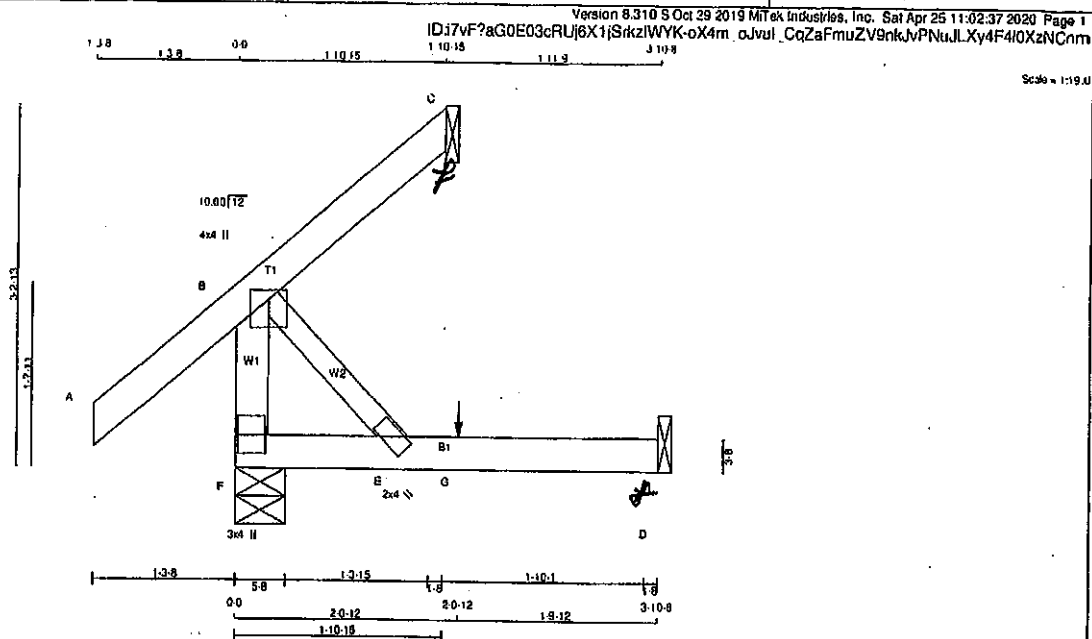

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
F - B	2x4	DRY	No.2		
A - C	2x4	DRY	No.2		
F - D	2x4	DRY	No.2		
ALL WEBS	2x3	DRY	No.2		
DRY: SEASONED LUMBER.					

PLATES (tab/plate in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMW+p	MT20	4.0	4.0	1.00	2.00
E	BMW+w	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG
	VERT	HORZ	DOWN	HORZ
F	297	0	297	0
C	42	0	42	0
D	36	0	40	0

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
F	208	145/0	0/0	0/0	0/0	83/0	0/0
C	29	23/-28	0/0	0/0	0/0	5/0	0/0
D	29	0/0	0/0	0/0	0/0	29/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	CS1 (LC)	UNBRAC	LENGTH	FR-TO	WEBS	MAX. FACTORED	MAX	CS1 (LC)
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	FROM	TO	FROM	TO	FROM	TO	FR-TO	MEMB.	FORCE (LBS)	MAX	CS1 (LC)
F-B	-281/0	0.0	0.0	0.03 (1)	7.81	B-E	0/0	0.00 (1)					
A-B	0/41	-91.8	-91.8	0.14 (5)	10.00								
B-C	-29/0	-91.8	-91.8	0.14 (5)	6.25								
F-E	0/0	-18.5	-18.5	0.08 (4)	10.00								
E-G	0/0	-18.5	-18.5	0.08 (4)	10.00								
G-D	0/0	-18.5	-18.5	0.08 (4)	10.00								

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	2-0-12	1	1	1	BACK	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 12 LB

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN/C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.01")

CS1: TO=0.14/1.00 (A-B:5), GC=0.08/1.00 (D-E:4),
WB=0.00/1.00 (B-E:1), SS=0.09/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	818 354	1887 788

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.20 (B) (INPUT = 0.80)
JSI METAL = 0.05 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007055


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408150	C2	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:02:38 2020 Page 1

ID:7vF7aG0E03cRUj6X1jSkziWYK-Gke8C8KXk63Sj9SKb4li7GVwpk52on6lpiY_zNCn

Scale = 1:19.0

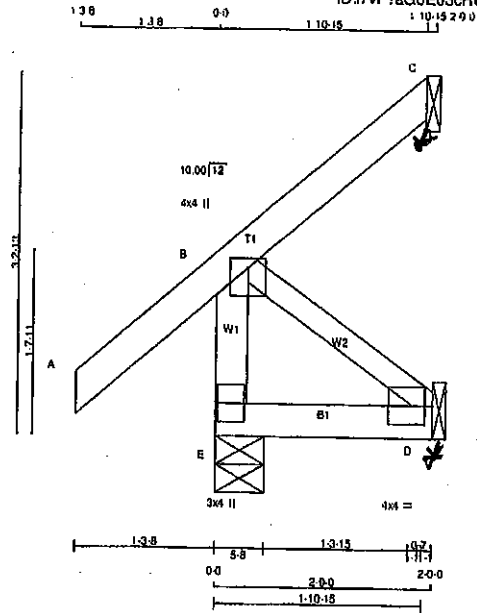

LUMBER				DESCR.
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	SPF
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF
ALL WEBS 2x3 DRY No.2				SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
D	BMV1-t	MT20	4.0	4.0	2.00 1.25
E	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
E	278	0	278	0	5-8
C	42	0	42	0	1-8
D	18	0	20	0	1-8

SEE MITEK STANDARD DETAIL B97701H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	194	145/0	0/0	0/0	0/0	0/0	48/0	0/0
C	29	23/-28	0/0	0/0	0/0	0/0	5/0	0/0
D	14	0/0	0/0	0/0	0/0	0/0	14/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADINGS

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD	LCI MAX	MAX. MEMB. FORCE (LBS)	MAX. FACTORED FORCE (LBS)
E-B	-281/0	0.0	0.03 (1)	7.81	0/0
A-B	0/41	-91.8	-91.8 0.13 (1)	10.00	
B-C	-29/0	-91.8	-91.8 0.12 (1)	8.25	
E-D	0/0	-18.5	-18.5 0.02 (4)	10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (TL) = L/360 (0.18")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.13/1.00 (A-B:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (B-D:1), SSI=0.08/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.20 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007056

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408152	C40	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:21 2020 Page 1
ID: i7vF7aG0E03cRUj6X1jSkzIwYK-q778eGk1873dG3CXkLfA19Pi_g08nd2vodDJZzNCOi

Scale = 1:17.9

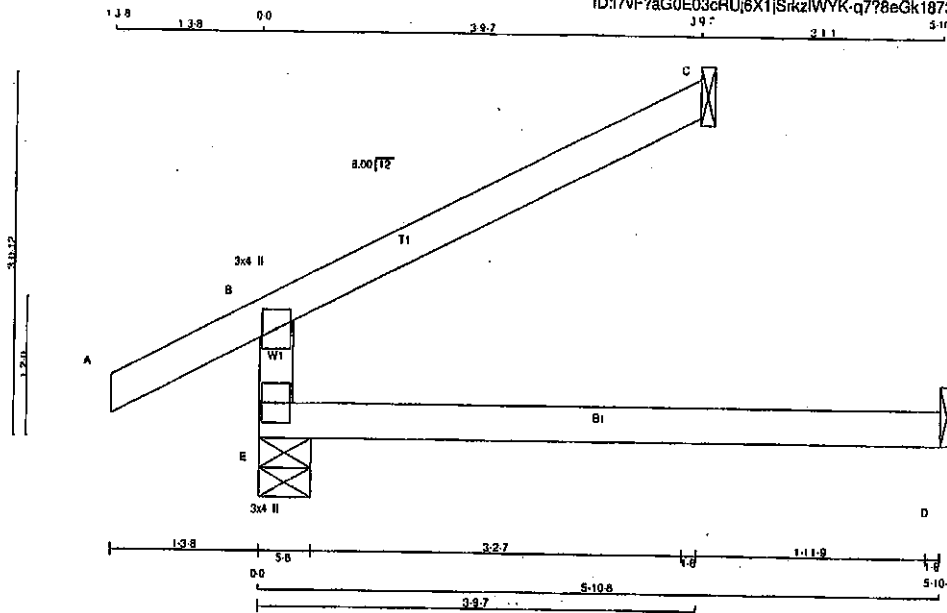

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
E - B	2x4 DRY	No.2	SPF
A - C	2x4 DRY	No.2	SPF
E - D	2x4 DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)			
JT TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0 4.0
E	BMV1+p	MT20	3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT REQ'D BRG
	VERT	DOWN	BRG
	HORZ	HORZ	IN-SX
E	405	0	5-8
C	130	0	1-8
D	45	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS			
JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	
	COMBINED	SNOW	LIVE
			PERM. LIVE
			WIND
			DEAD
			SOIL
E	288	190 / 0	0 / 0
C	90	73 / 0	0 / 0
D	38	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)
FR-TO		FROM TO	UNBRAC LENGTH FR-TO
E-B	-342 / 0	0.0	0.0 0.13 (4)
A-B	0 / 28	-81.8	-81.8 0.12 (1)
B-C	-19 / 0	-81.8	-81.8 0.22 (1)
E-D	0 / 0	-18.5	-18.5 0.13 (4)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.22/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WS=0.00/1.00 (N/A:0), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1668


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.14 (E) (INPUT = 0.90)
JSI METAL=0.09 (B) (INPUT = 1.00)

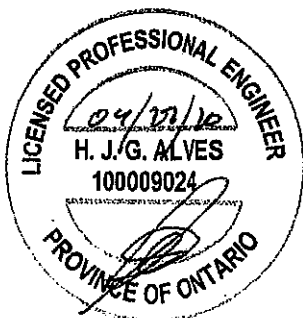

Structural component only
DWG# T-2007098

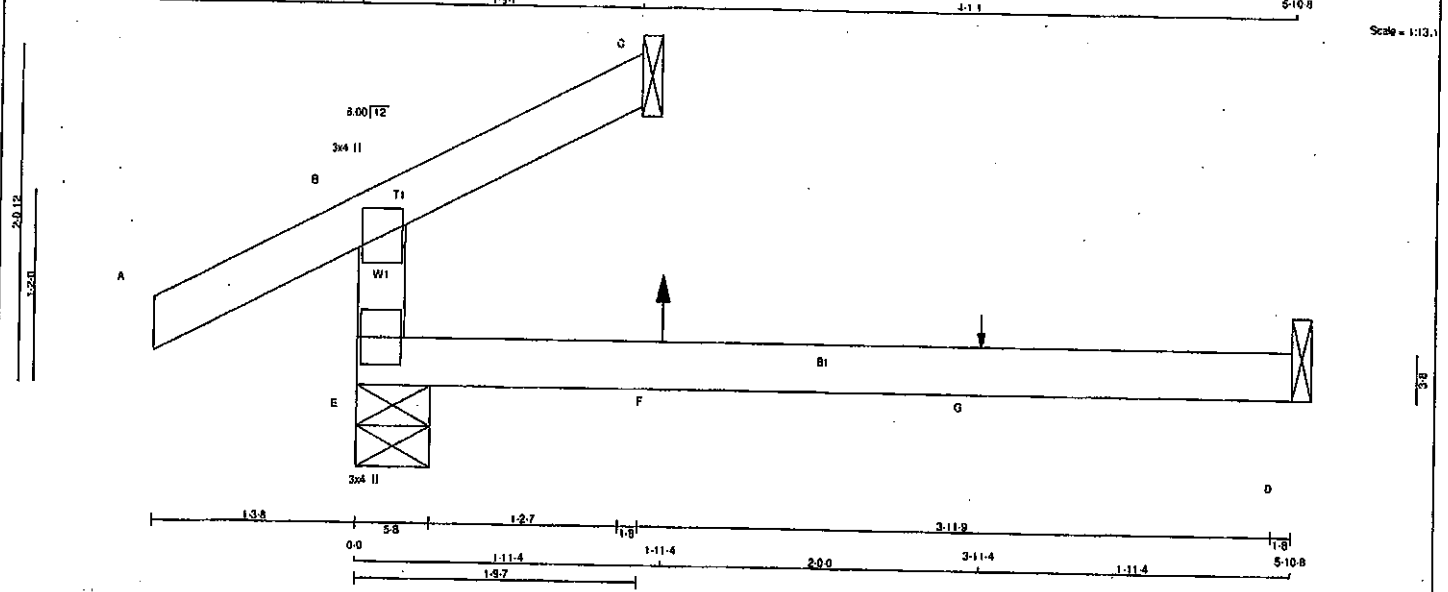

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				TOTAL WEIGHT = 4 X 12 = 48 lb			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	SPF	SPF	SPF				
E - B	2x4	DRY	No.2	SPF							
A - C	2x4	DRY	No.2	SPF							
E - D	2x4	DRY	No.2	SPF							

DRY: SEASONED LUMBER.

PLATES (table is in inches) <table> <tr> <th>JT</th> <th>TYPE</th> <th>PLATES</th> <th>W</th> <th>LEN</th> <th>Y</th> <th>X</th> </tr> <tr> <td>B</td> <td>TMV+p</td> <td>MT20</td> <td>3.0</td> <td>4.0</td> <td></td> <td></td> </tr> <tr> <td>E</td> <td>BMV+p</td> <td>MT20</td> <td>3.0</td> <td>4.0</td> <td></td> <td></td> </tr> </table>							JT	TYPE	PLATES	W	LEN	Y	X	B	TMV+p	MT20	3.0	4.0			E	BMV+p	MT20	3.0	4.0			SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D UNFACTORED REACTIONS <table> <tr> <th>JT</th> <th>1ST LCASE</th> <th>MAX/MIN COMPONENT REACTIONS</th> <th></th> <th></th> <th></th> <th></th> </tr> <tr> <td></td> <td>COMBINED</td> <td>SNOW</td> <td>LIVE</td> <td>PERM.LIVE</td> <td>WIND</td> <td>DEAD</td> </tr> <tr> <td>E</td> <td>200</td> <td>137.0</td> <td>0.0</td> <td>0.0</td> <td>0.0</td> <td>62.0</td> </tr> <tr> <td>C</td> <td>48</td> <td>21.0</td> <td>0.0</td> <td>0.0</td> <td>0.0</td> <td>26.0</td> </tr> <tr> <td>D</td> <td>36</td> <td>0.3</td> <td>0.0</td> <td>0.0</td> <td>0.0</td> <td>37.0</td> </tr> </table>					JT	1ST LCASE	MAX/MIN COMPONENT REACTIONS						COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	E	200	137.0	0.0	0.0	0.0	62.0	C	48	21.0	0.0	0.0	0.0	26.0	D	36	0.3	0.0	0.0	0.0	37.0	TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN.C/C THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF NBCC 2010, CBC 2012, ABC 2019 - PART 9 OF CBC 2012 (2019 AMENDMENT)				
JT	TYPE	PLATES	W	LEN	Y	X																																																																		
B	TMV+p	MT20	3.0	4.0																																																																				
E	BMV+p	MT20	3.0	4.0																																																																				
JT	1ST LCASE	MAX/MIN COMPONENT REACTIONS																																																																						
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD																																																																		
E	200	137.0	0.0	0.0	0.0	62.0																																																																		
C	48	21.0	0.0	0.0	0.0	26.0																																																																		
D	36	0.3	0.0	0.0	0.0	37.0																																																																		

BEARING				BRACING				LOADING			
JT	VERT	HORZ	DOWN	UP	IN-SX	IN-SX		TOTAL LOAD CASES: (7)			
E	284	0	284	0	0	5.8	5.8				
C	63	0	63	0	0	1.8	1.8				
D	44	0	52	0	0	1.8	1.8				

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

CHORDS				WEBS				ALLOWABLE DEFL. (LL) = L/360 (0.20")			
MEMB.	MAX. FACTORED	VERT. LOAD	LC1 MAX	MAX. FACTORED	MEMB.	MAX. FACTORED	MEMB.	ALLOWABLE DEFL. (TL) = L/800 (0.01")			
FR-TO					FR-TO		FR-TO	ALLOWABLE DEFL. (TL) = L/800 (0.01")			
E-B	227/0	0.0	0.0	0.11 (4)	7.81			CS1: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4),			
A-B	0/28	-91.8	-91.8	0.12 (1)	10.00			WB=0.00/1.00 (n/a:0), SS1=0.08/1.00 (A-B:1)			
B-C	9/9	-91.8	-91.8	0.09 (4)	10.00			CS1: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4),			
E-F	0/0	-18.5	-18.5	0.14 (4)	10.00			WB=0.00/1.00 (n/a:0), SS1=0.08/1.00 (A-B:1)			
F-G	0/0	-18.5	-18.5	0.14 (4)	10.00			CS1: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4),			
G-D	0/0	-18.5	-18.5	0.14 (4)	10.00			WB=0.00/1.00 (n/a:0), SS1=0.08/1.00 (A-B:1)			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	1-11.4	7	1	12	BACK	VERT	TOTAL		C1
G	3-11.4	1	1		BACK	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/800 (0.01")
CALCULATED VERT. DEFL. (TL) = L/999 (0.01")

CS1: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SS1=0.08/1.00 (A-B:1)

DOL LUMBER=0.98 NAIL=0.98 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	618	354	1867 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)
JSI METAL = 0.08 (B) (INPUT = 1.00)

LICENSED PROFESSIONAL ENGINEER
H. J. G. ALVES
100009024
PROVINCE OF ONTARIO

Structural component only.
DWG# T-2007099


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408152	C42	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:24 2020 Page 1

ID:37vF?aG0E03cRUj6X1jSkzIWK-FihGGHmV2RB7Xx6PivMognw6CsuL8MVcmrHwuzNCOI

Scale = 1:18.2

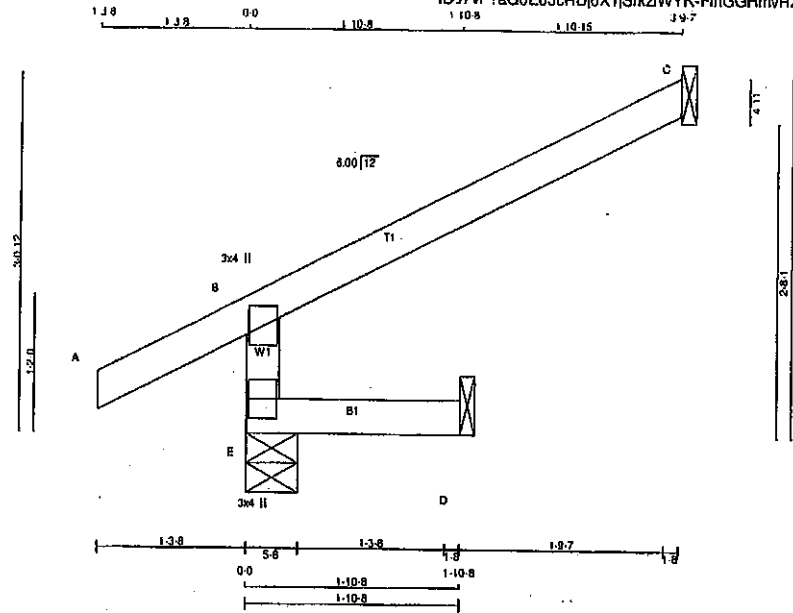

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHOIDS			
E - B	2x4 DRY	No.2	SPF
A - C	2x4 DRY	No.2	SPF
E - D	2x4 DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT	REQ'D		
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UP/LIFT	BRG	IN-SX
E	361	0		361	0	0	5-8	5-8	5-8
C	130	0		130	0	0	1-8	1-8	1-8
D	18	0		17	0	0	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	250	190/0	0/0	0/0	0/0	0/0	0/0	80/0	0/0
C	90	73/0	0/0	0/0	0/0	0/0	0/0	17/0	0/0
D	12	0/0	0/0	0/0	0/0	0/0	0/0	12/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD	LC1 MAX	MAX. MEMB. FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM	TO	LENGTH	FR-TO
E-B	-342/0	0.0	0.0	0.01 (4)	7.81
A-B	0/28	-91.8	-91.8	0.13 (5)	10.00
B-C	-19/0	-91.8	-91.8	0.22 (1)	8.25
E-D	0/0	-18.5	-18.5	0.02 (4)	10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 4 X 10 = 38 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	38.0	PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00")

CS: TC=0.22/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (N/A:0), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (E) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007100

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408152	C43	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Sat Apr 25 11:29:25 2020 Page 1
ID:17vF7aG0E03cRUj8X1SRkzIWK-juETdnYCMa2lgWizbQbKik7UcCo4bosqQbrSKz2NCOe

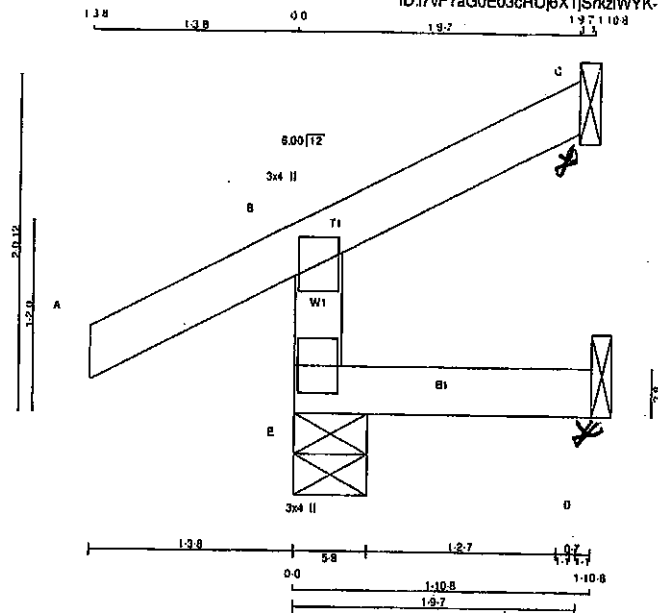

Scale = 1/12.1

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No. 2		
A - C	2x4	DRY	No. 2		
E - D	2x4	DRY	No. 2		

DRY: SEASONED LUMBER.

DESCR.
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	271	0	271	0	5-8	5-8
C	45	0	45	0	1-8	1-8
D	8	0	17	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST CASE		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
E	188	141/0	0/0	0/0	0/0	47/0	0/0
C	31	24/-18	0/0	0/0	0/0	7/0	0/0
D	7	0/-8	0/0	0/0	0/0	12/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (6)

CHORDS				WEBS			
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FORCE (LBS)	FACTORED MAX. CSI (LC)
FR-TO		FROM TO		FR-TO			
E-B	-244 / 0	0.0	0.0 (5)	7.81			
A-B	0 / 28	-91.8	-91.8 (1)	10.00			
B-C	-17 / 0	-91.8	-91.8 (1)	6.25			
E-D	0 / 0	-18.5	-18.5 (5)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 4 X 7 = 28 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5),
WB=0.00/1.00 (W:A:0), SS=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (ORY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN
MT20	618	354	1667	788
			1987	1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)

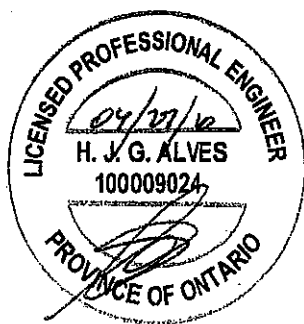


Structural component only
DWG# T-2007101

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRAWG NO.
408152	C44	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:28 2020 Page 1
ID:7vF?aG0E03cRUjBX1(Srkz)WYK-B4o1hzoAzgJvMq5UXlkq15IH1?X4p2an34KO_nzNCOd

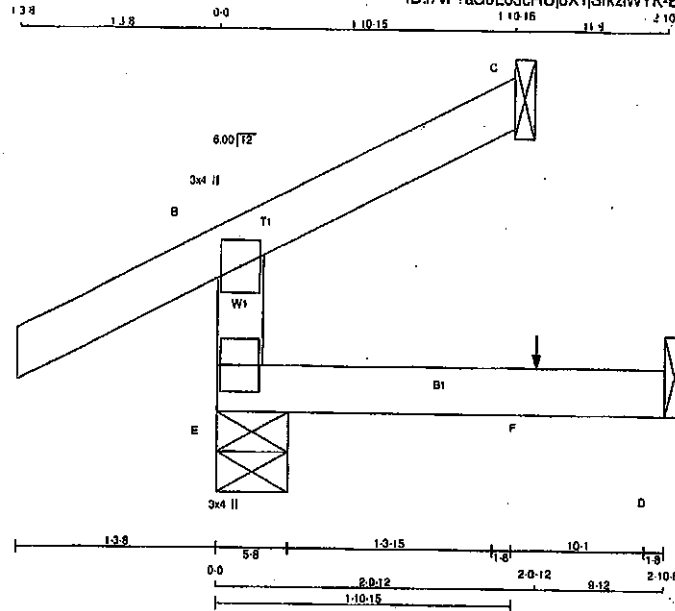

Scale = 1/4" = 1'-0"

LUMBER				DESCR.	SPF
N. L. G. A. RULES	SIZE	LUMBER			
CHORDS					
E - B	2x4	DRY	No.2		
A - C	2x4	DRY	No.2		
E - D	2x4	DRY	No.2		

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	DOWN	HORZ	BRG	IN-SX	BRG	IN-SX
E	284	0	284	0	0	5-8	5-8		
C	88	0	88	0	0	1-8	1-8		
D	23	0	23	0	0	1-8	1-8		

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM	LIVE	WIND	DEAD	SOIL
E	185	130/0	0/0	0/0	0/0	0/0	55/0	0/0
C	46	37/0	0/0	0/0	0/0	0/0	9/0	0/0
D	18	0/0	0/0	0/0	0/0	0/0	18/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LOC1	MAX. MEMB.	FORCE (LBS)	MAX. MEMB.	FORCE (LBS)
FR-TO		FROM	TO	LENGTH	FR-TO		
E-B	-234/0	0.0	0.0	0.02 (4)	7.81		
A-B	0/28	-91.8	-91.8	0.13 (5)	10.00		
B-C	-10/0	-91.8	-91.8	0.06 (1)	10.00		
E-F	0/0	-18.5	-18.5	0.03 (4)	10.00		
F-D	0/0	-18.5	-18.5	0.03 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LOC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
F	2-0-12	1	1	FRONT	VERT	TOTAL		CI

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 2 X 8 = 17 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.0	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCO 2010, NBCO 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(66% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.13/1.00 (A-B-5), BC=0.03/1.00 (D-E-4),
WB=0.00/1.00 (N/A:0), SSI=0.10/1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PU)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1887 789	1987 1836

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007102

Tamarack Roof Truss, Burlington



LONG A RILES

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

WILLIAMS BEARINGS

FACTORED		MAXIMUM FACTORED		INPUT	RECORD
JT	GROSS REACTION	GROSS REACTION	8RG	BRG	
	VERT	HORZ	DOWN	UPLIFT	IN-SX
E	254	0	254	0	5-8
C	68	0	68	0	1-8
D	18	0	18	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C. D.

UNFACTORED REACTIONS

1ST LASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	177	130 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0
C	48	37 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0
D	13	0 / 0	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E. C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED

LOADING

TOTAL LOAD CASES: (5)

CHORDS					WEBBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO				FR-TO			
E-B	-234 / 0	0.0	0.0	0.01 (4)	7.81				
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00				
B-C	-10 / 0	-91.8	-91.8	0.08 (1)	10.00				
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD		=	39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
 CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
 ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
 CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SSI=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY Y

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007103

LUL/LUS/LJS/HUS/HHUS/HGUS

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.

Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:

- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:

- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on p. 126.




Double-Shear
Nailing
Top View




Double-Shear
Nailing
Side View;
Do not
bend tab




Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,680

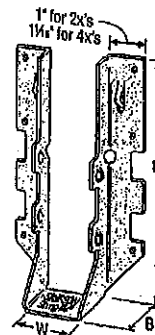


LUS28




LU26L

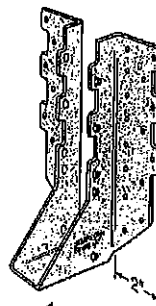


HUS210
(HUS26, HUS28,
and HHUS similar)



HGUS28-2




HHUS210-2



LJS26DS

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

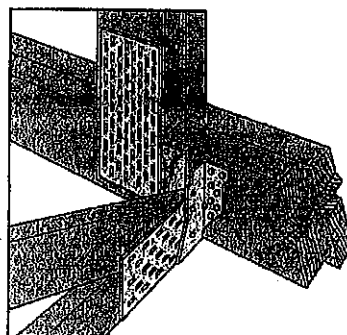

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS**SIMPSON**
Strong-Tie**HHUS/HGUS**

See Hanger Options information on pp. 125–127.


HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
W < 2"	Bevel or square cut	0.62 of table value	0.46 of table value
2" < W < 6"	Bevel cut	0.67 of table value	0.41 of table value
2" < W < 6"	Square cut	0.46 of table value	0.41 of table value
W > 6"	Bevel cut	0.75 of table value	0.41 of table value

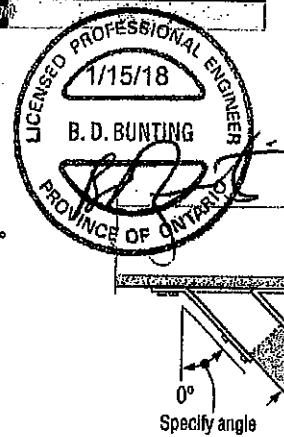

Top View HHUS Hanger Skewed Right
(joist must be bevel cut)
All joist nails installed on the outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _a ³	Header	Joist	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN	(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN
Single 2x Sizes											
LUS24	18	1 1/8	3 1/4	1 1/4	2 1/4	(4) 10d	(2) 10d	710 3.16	1625 7.23	845 2.87	1155 5.14
LU24L	22	1 1/8	3	1 1/4	2 1/4	(4) 10d	(2) 10d x 1 1/2"	360 1.60	1020 4.54	320 1.42	725 3.22
LU26L	22	1 1/8	5	1 1/4	4 1/4	(6) 10d	(4) 10d x 1 1/2"	720 3.20	1805 7.14	645 2.87	1140 5.07
LUS26	18	1 1/8	4 1/4	1 1/4	3 3/4	(4) 10d	(4) 10d	1420 6.32	2170 9.85	1290 5.74	1630 7.25
HUS28	18	1 1/8	5 1/4	3	3 1/4	(14) 10d	(8) 18d	2705 11.30	4940 21.97	2065 9.20	3875 17.24
LJS26DS	18	1 1/8	5	3 1/2	4 1/4	(16) 16d	(8) 18d	2055 9.14	4265 18.97	1480 6.49	4115 18.31
HGUS26	12	1 1/8	5 1/4	5	4 1/4	(20) 16d	(8) 18d	2885 11.98	6625 29.51	2685 11.96	5700 25.35
LU28L	20	1 1/8	6 1/4	1 1/4	5 1/4	(8) 10d	(6) 10d x 1 1/2"	1140 5.07	2185 9.72	1020 4.54	1550 6.89
LUS28	18	1 1/8	6 1/4	1 1/4	3 3/4	(8) 10d	(4) 10d	1420 6.32	2620 11.21	1290 5.74	1790 7.96
HUS28	16	1 1/8	7 1/4	3	6 1/4	(22) 18d	(8) 18d	3805 16.04	5385 23.86	2675 11.90	4345 19.33
HGUS28	12	1 1/8	7 1/4	5	6 1/4	(36) 16d	(12) 16d	3310 14.74	7675 34.19	3310 14.74	6800 30.73
LU210L	20	1 1/8	8	1 1/4	7 1/4	(10) 10d	(8) 10d x 1 1/2"	1140 5.07	2495 11.10	1020 4.54	1770 7.87
LUS210	18	1 1/8	7 1/4	1 1/4	3 3/4	(8) 10d	(4) 10d	1420 6.32	2785 12.39	1290 5.74	2210 9.83

1. Factored uplift resistances have been increased 16% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_a is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSON and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27–28 for other nail sizes and information.


Face-Mount Hangers

SIMPSON
Strong-Tie

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _g ¹	Header	Jolst	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _g = 1.15)	(K _g = 1.00)	(K _g = 1.15)	(K _g = 1.00)
								lb.	lb.	lb.	lb.
								kN	kN	kN	kN
Double 2x Sizes											
LUS24-2	18	3 1/8	3 1/8	2	1 1/2	(4) 16d	(2) 16d	835	2020	590	1435
SS LUS26-2	18	3 1/8	4 1/8	2	4	(4) 16d	(4) 16d	3.71	8.99	2.62	6.38
HHUS26-2	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(8) 16d	1720	2595	1545	1920
HGUS26-2	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	7.65	11.54	6.87	8.64
SS LUS28-2	18	3 1/8	7	2	4	(6) 16d	(4) 16d	2850	7335	2065	5205
HHUS28-2	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	12.68	32.63	9.20	23.15
HGUS28-2	12	3 1/8	7 1/8	4	8 1/8	(36) 16d	(12) 16d	4385	8950	3110	6355
SS LUS210-2	18	3 1/8	9	2	8	(8) 16d	(8) 16d	19.51	39.81	13.83	28.27
HHUS210-2	14	3 1/8	9 1/8	3	8	(30) 16d	(10) 16d	1720	3325	1545	2575
HGUS210-2	12	3 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	7.65	14.79	6.87	11.45
								3785	8940	2675	6345
								16.75	39.77	11.90	28.22
								6070	12980	4310	9215
								27.00	57.74	19.17	40.99
								2580	4500	2320	3195
								11.48	20.02	10.32	14.21
								4670	9660	4235	7000
								20.77	42.97	18.84	31.14
								6840	14015	4855	10270
								30.43	62.34	21.60	45.69
Triple 2x Sizes											
HGUS26-3	12	4 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
HGUS28-3	12	4 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	19.51	39.81	13.83	28.27
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d	6070	12980	4310	9215
HGUS210-3	12	4 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	27.00	57.74	19.17	40.99
								4670	9670	4235	6865
								20.77	43.02	18.84	30.64
								6840	14645	4855	10400
								30.43	65.14	21.60	46.28
Quadruple 2x Sizes											
HGUS26-4	12	6 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
HGUS28-4	12	6 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	19.51	39.81	13.83	28.27
HHUS210-4	14	6 1/8	8 1/8	3	7 1/8	(30) 16d	(10) 16d	6070	12980	4310	9215
HGUS210-4	12	6 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	27.00	57.74	19.17	40.99
								4670	10165	4235	7210
								20.77	45.17	18.84	32.07
								6840	14645	4855	10400
								30.43	65.14	21.60	46.28
								7640	14995	5425	10645
								33.98	66.70	24.13	47.35
								10130	16400	7195	11645
								45.06	72.95	32.00	51.80
4x Sizes											
LUS46	18	3 1/8	4 1/8	2	3 1/8	(4) 16d	(4) 16d	1720	2595	1545	1920
HHUS46	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(8) 16d	7.65	11.54	6.87	8.64
HGUS46	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	2540	7335	2065	5205
LUS48	18	3 1/8	6 1/8	2	3 1/8	(8) 16d	(4) 16d	11.30	32.63	9.20	23.15
HHUS48	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	4385	8950	3110	6355
HGUS48	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	19.51	39.81	13.83	28.27
LUS410	18	3 1/8	8 1/8	2	5 1/8	(8) 16d	(8) 16d	1720	3325	1545	2575
HHUS410	14	3 1/8	9 1/8	3	8 1/8	(30) 16d	(10) 16d	7.65	14.79	6.87	11.45
HGUS410	12	3 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	3785	8940	2675	6345
								16.75	39.77	11.90	28.22
								6070	12980	4310	9215
								27.00	57.74	19.17	40.99
								2580	4500	2320	3195
								11.48	20.02	10.32	14.21
								4670	9660	4235	7000
								20.77	42.97	18.84	31.14
								6840	14015	4855	10270
								30.43	62.34	21.60	45.69
								7640	14995	5425	10645
								33.98	66.70	24.13	47.35
								10130	16400	7195	11645
								45.06	72.95	32.00	51.80



Plated Truss Connectors

See footnotes on p. 258.

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1/4". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

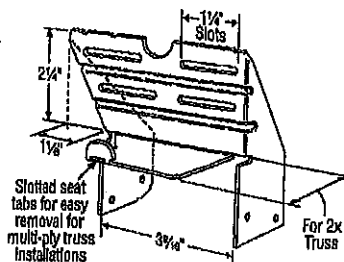


TC24
U.S. Patent 4,932,173

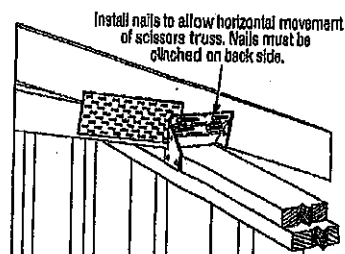


Typical TC24 Installation

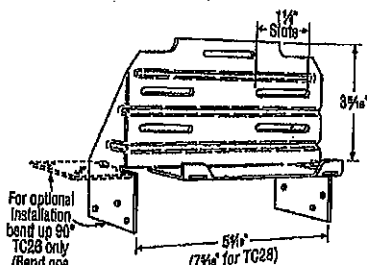

TC26
(TC28 Similar)

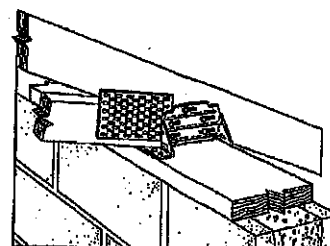

Optional TC26 Installation for Grouted Concrete Block using a Wood Nail
(8", 10", 12" Wall Installation Similar)

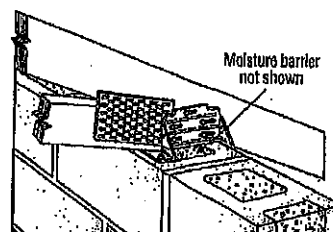

Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _c =1.16)	Uplift (K _c =1.16)
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(6) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _c =1.16)	Uplift (K _c =1.16)
TC28	(5) 10d	(6) 10d x 1 1/2"	810	680
	(5) 10d	(6) 10d	930	680

1. Factored resistances have been increased 16% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.
2. Grout strength is 15 MPa minimum.
3. Optional TC28 installation with 10d nails requires minimum 3" top plate thickness.
4. TC28 fastened to grouted concrete block with (6) - 3/8" x 2 1/4" Titen screws has a factored uplift resistance of 275 lb.



UNITED STATES
DESIGN

(800) 999-5099
strongtie.com

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Gr.	Fasteners			Factored Resistance ($K_D = 1.15$)					
					D.Fir-L			S-P-F		
		To Rafters/Truss	To Plates	To Studs	Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(5) 8d x 1½"	(4) 8d	—	740	685	300	680	485	215
					3.29	3.05	1.33	3.02	2.16	0.98
SS H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
					3.58	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	160	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	265	615	125	180
					3.29	0.80	1.18	2.74	0.56	0.85
H6	16	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	870	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS H8 ^a	18	(5) 10d x 1½"	(5) 10d x 1½"	—	1120	—	—	1025	—	—
					4.98	—	—	4.56	—	—
SS H10A ^a	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	565	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.64	1.36
H10A-2	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1835	1275	430	1645	880	305
					8.16	5.67	1.91	7.32	3.91	1.36
H10S ^{a,b}	18	(8) 8d x 1½"	(8) 8d x 1½"	(8) 8d	1465	795	315	1040	565	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2½"	(6) 16d x 2½"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	[1] (12) 8d x 1½"	(13) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
		[2] (12) 8d x 1½"	(15) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
TSP	18	(9) 10d x 1½"	(6) 10d x 1½"	—	1295	440	—	920	310	—
					5.76	1.98	—	4.09	1.38	—
		(9) 10d x 1½"	(6) 10d	—	1560	440	—	1105	310	—
					6.94	1.98	—	4.92	1.38	—

- Factored resistances have been increased 15% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 595 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HIECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 8/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1½" nails into the top plates and (3) 8d x 1½" nails into the lowest three flange holes into the truss bottom chord is 495 lb. (2.20 kN).
- Nails: 16d x 2½" = 0.162" dia. x 2½" long, 10d = 0.148" dia. x 3" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long, 8d x 1½" = 0.131" dia. x 1½" long. See pp. 27-28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

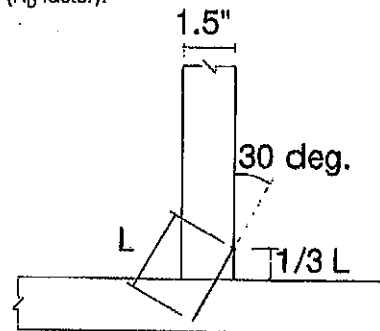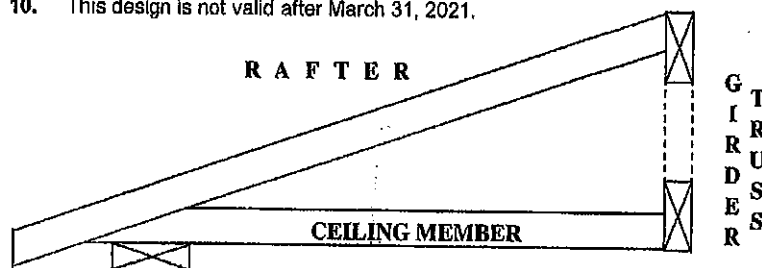


TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019.



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind or earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

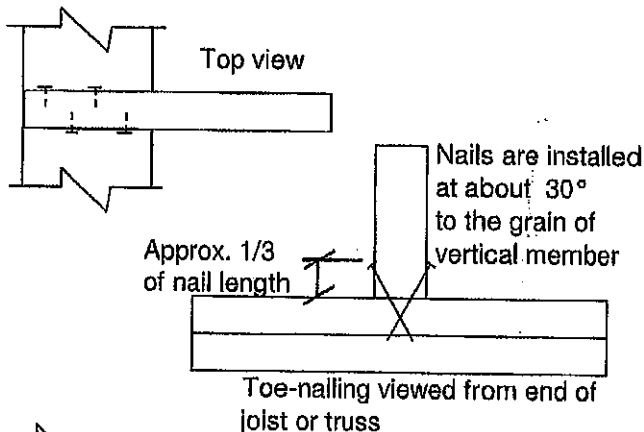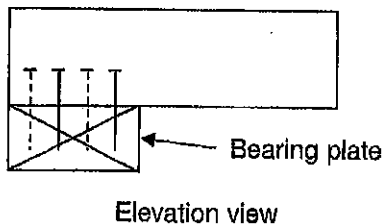

Toe-nailing on 2x4 Bearing Plate

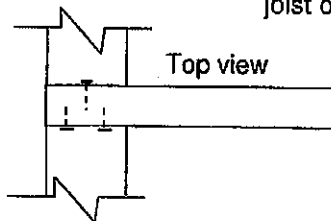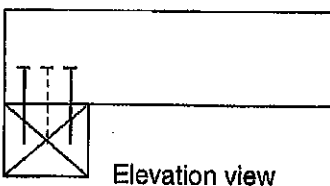

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7



December 2, 2019

PEO
Certificate No. 10889485



Symbols

PLATE LOCATION AND ORIENTATION



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.

Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
- DSB-89: Design Standard for Bracing
- BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

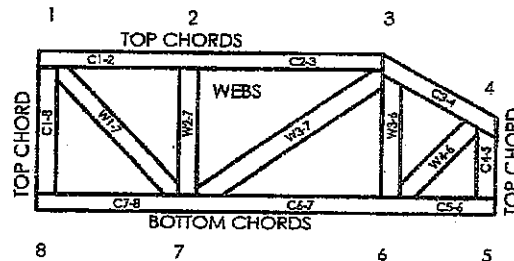

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MII-7473C rev. 10-'08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected ovetop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

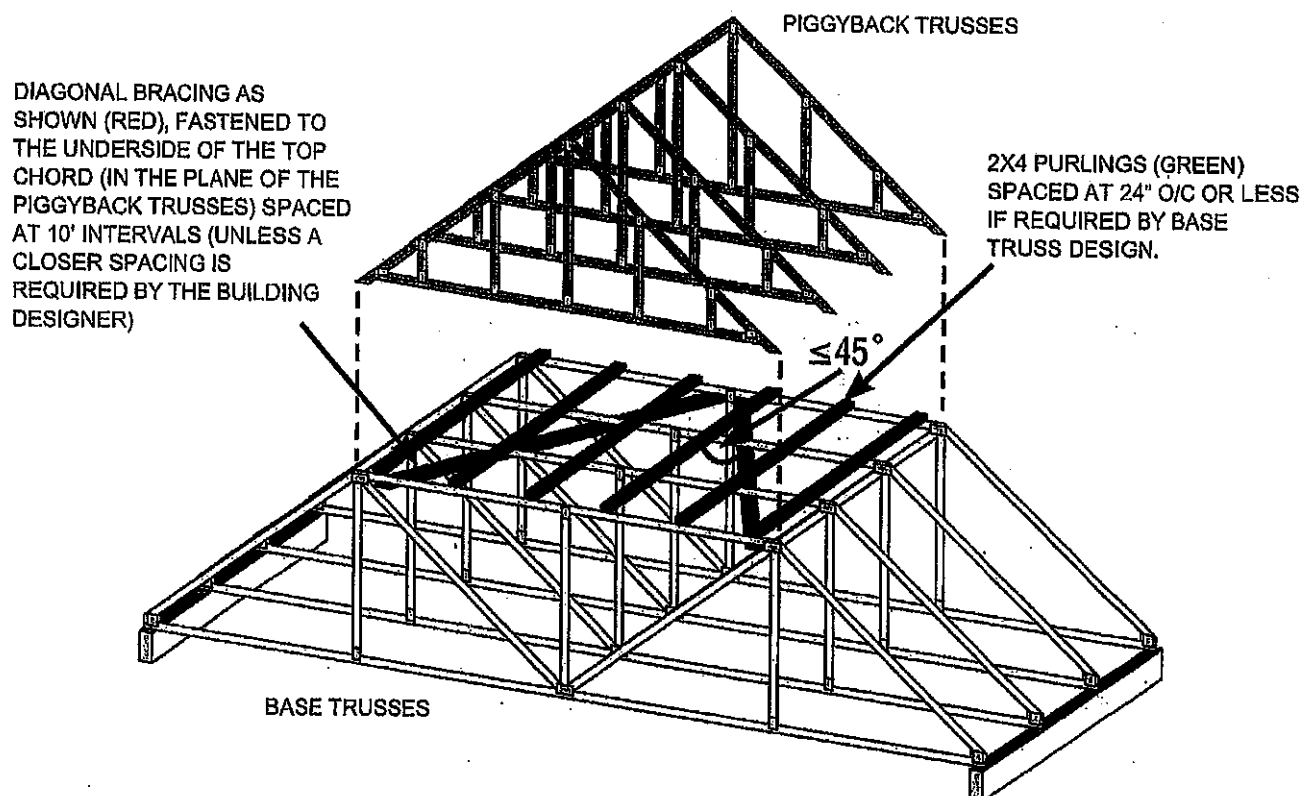

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as Individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

F-1300213

Feb 09, 2018