

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 6
 Lot #: 3/6
 Elevation: 3- STD OR OPT.5 BR

Job Track: 51225
 PlanLog: 202419
 Layout ID: 408224
 Ref #
 Page: 1 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T40 Hip Girder	6 / 12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	337.56 208.00		
	1 2-ply	T40Z Hip Girder	6 / 12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	337.56 208.00		
	2	T41 Hip	6 / 12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.99 174.00		
	2	T42 Hip	6 / 12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.12 174.67		
	2	T43 Hip	6 / 12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	289.07 179.67		
	2	T44 Hip	6 / 12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	290.73 183.33		
	2	T45 Hip	6 / 12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	301.67 191.33		
	8	T46 Common	6 / 12	35-02-00	9-11-08	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1178.98 726.33		
	2	T47S Roof Special	0 / 12	10-06-00	3-06-00	2 x 4		3-06-00 3-06-00	101.09 63.67		
	1	T48 Half Hip	6 / 12	10-06-00	2-08-00	2 x 4	1-03-08	1-02-00 2-08-00	39.94 26.67		
	1	T49 Half Hip	6 / 12	10-06-00	3-08-00	2 x 4	1-03-08	1-02-00 3-08-00	41.91 27.50		
	2	T50 Flat	0 / 12	5-07-00	3-00-00	2 x 4		3-00-00 3-00-00	45.54 30.00		
	1	G50 GABLE	0 / 12	5-07-00	3-00-00	2 x 4		3-00-00 3-00-00	22.18 15.00		
	1	T51 Hip Girder	6 / 12	10-05-00	3-07-04	2 x 4	1-03-08	1-02-00 1-03-08	43.52 29.67		



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 6
 Lot #: 316
 Elevation: 3- STD OR OPT.5 BR

Job Track: 51225
 PlanLog: 202419
 Layout ID: 408224
 Ref #
 Page: 2 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T52 Hip	6 / 12	10-05-00	4-00-00	2 x 4	1-03-08	2-02-00 2-03-08	45.94 29.83		
	1	T53 Hip Girder	6 / 12	10-05-00	3-00-00	2 x 4	1-03-08	2-02-00 2-03-08	46.32 31.83		
	1 2-ply	T54S Roof Special Girder	0 / 12	10-06-08	2-02-00	2 x 4 2 x 6		1-02-00 2-02-00	97.7 64.33		
	18	J1 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	302.3 192.00		
	2	J40 Jack-Open	6 / 12	4-10-08	3-07-04	2 x 4	1-03-08	1-02-00 3-07-04	28.76 18.67		
	5	J41 Jack-Open	6 / 12	2-06-08	3-00-00	2 x 4		1-08-12 3-00-00	49.19 34.17		
	2	J42 Jack-Open	6 / 12	5-05-08	4-01-04	2 x 4		1-04-08 4-01-04	31.44 20.67		
	2	C40 Jack-Open	6 / 12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	28.26 17.33		
	2	C41 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	23.16 14.67		
	3	C42 Jack-Open	6 / 12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	28.71 18.00		
	3	C43 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	21.08 14.00		
	2	C44 Jack-Open	6 / 12	3-09-07	3-00-12	2 x 4	1-03-08 1-01-01	1-02-00 3-00-12	25.98 16.00		
	2	C45 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 3-01-01	1-02-00 2-00-12	20.88 13.33		
	1	C46 Jack-Open	6 / 12	1-07-08	3-00-12	2 x 4	1-10-15	1-03-08 2-01-04	7.46 5.33		

 TAMARACK ROOF TRUSSES INC. ALFA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: MOUNTAINASH 6 Lot #: 316 Elevation: 3- STD OR OPT.5 BR	Job Track: 51225 PlanLog: 202419 Layout ID: 408224 Ref # Page: 3 of 3 Date: 04-27-2020 Designer: Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	C47 Jack-Open	6 /12	1-07-08	2-00-12	2 x 4		1-03-08 2-01-04	4.91 3.33		

TOTAL # TRUSS= 77 TOTAL BFT OF ALL TRUSSES= 2730.33 BFT. TOTAL WEIGHT OF ALL TRSSES 4346.93 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	HGUS26-2	
1	Hardware	LJS26DS	
14	Hardware	LUS24	
2	Hardware	LUS26-2	



TOTAL NUMBER OF
ITEMS= 18

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T1	1	2	TRUSS DESC.		

Tanarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:00:04 2020 Page 1

ID:DMCubINVR6TstF0a31v6l zns11-Jm9J91AhZi22g2EEeMnZsEz3HThi?mEdCAUuvczMFH

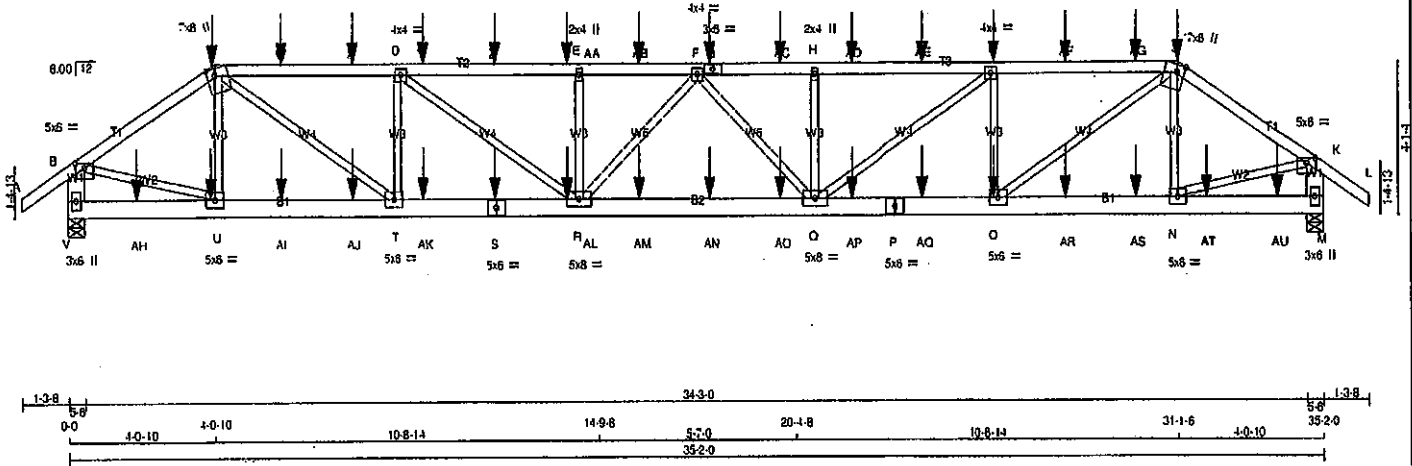

TOTAL WEIGHT = 2 X 161 = 323 lb

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - G	2x4	DRY	No.2
G - J	2x4	DRY	No.2
J - L	2x4	DRY	No.2
V - B	2x8	DRY	No.2
M - K	2x6	DRY	No.2
V - S	2x6	DRY	No.2
S - P	2x6	DRY	No.2
P - M	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	SIDE(61.0)
C - G	12	SIDE(61.0)
G - J	12	SIDE(61.0)
J - L	12	SIDE(61.0)
V - B	12	TOP
M - K	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
V - S	12	SIDE(163.1)
S - P	12	SIDE(163.1)
P - M	12	SIDE(163.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	UP	BRG	IN-SX	BRG	IN-SX
V	3393	0	0	3393	0	5-8	5-8	5-8	5-8
M	3342	0	0	3342	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST CASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
V	2397	1585	0	0	0
M	2363	1555	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.11 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING		TOTAL LOAD CASES: (4)	
CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO			
A-B	0	35	
B-C	-4024	0	
C-W	-6074	0	
W-X	-6074	0	
X-D	-6074	0	
D-Y	-7423	0	
Y-Z	-7423	0	
Z-AA	-7423	0	
AA-E	-7423	0	
E-AB	-7423	0	
AB-F	-7423	0	
F-G	-7410	0	
G-AC	-7410	0	
AC-H	-7410	0	
H-AD	-7410	0	
AD-AE	-7410	0	
AE-I	-7410	0	
I-AF	-6040	0	
AF-AG	-6040	0	
AG-J	-6040	0	
J-K	-3943	0	
K-L	0	35	
V-B	-3355	0	
M-K	-3298	0	

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 55.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.23")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/970 (0.44")

CS: TC=0.63/1.00 (D-E:1), BC=0.57 1.00 (Q-R:1), WB=0.43/1.00 (B-U:1), SS=0.19/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.86 (I) INPUT = 0.90 I
JSI METAL= 0.58 (I) INPUT = 1.00 I

CONTINUED ON PAGE 2



Structural component only
DWG# T-2007602 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T1	1	2	TRUSS DESC.		

Teharack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Tue Apr 28 09:00:04 2020 Page 2

ID:DMCubINVR6T9F0831v6I zns1I-Jm9J91AhZi22o2EEmlNZsEz3HTHi7mEdCAUuv0zMFIt

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMW-p	MT20	5.0	6.0	1.50	3.00
C	TTWW-m	MT20	7.0	8.0	Edge	2.50
D, F, J						
D	TMW-i	MT20	4.0	4.0		
E	TMW-w	MT20	2.0	4.0		
G	TS-i	MT20	3.0	6.0		
H	TMW-w	MT20	2.0	4.0		
J	TTWW-m	MT20	7.0	8.0	Edge	2.50
K	TMW-p	MT20	5.0	6.0	1.50	3.00
M	BMV-i-p	MT20	3.0	6.0		
N, O, T, U						
N	BMW-i	MT20	5.0	6.0		
P	BS-i	MT20	5.0	6.0		
Q	BMWW-i	MT20	5.0	8.0		
R	BMWW-i	MT20	5.0	8.0		
S	BS-i	MT20	5.0	6.0		
V	BMV-i-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 (LBS)	MAX. UNBRAC LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC1)
FR-TO		FROM	TO				
AR-AS	0 3281	-18.5	-18.5 0.25 (1)	10.00			
AS-N	0 3281	-18.5	-18.5 0.25 (1)	10.00			
N-AT	0 0	-18.5	-18.5 0.04 (4)	10.00			
AT-AU	0 0	-18.5	-18.5 0.04 (4)	10.00			
AU-M	0 0	-18.5	-18.5 0.04 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-10	-49	-55	---	FRONT	VERT	DEAD	---	C1
C	4-0-10	-117	-117	---	FRONT	VERT	TOTAL	---	C1
C	4-0-10	-254	-254	---	FRONT	VERT	SNOW	---	C1
G	17-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
I	25-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
J	31-1-6	-49	-55	---	FRONT	VERT	DEAD	---	C1
J	31-1-6	-254	-254	---	FRONT	VERT	SNOW	---	C1
O	25-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
S	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
U	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
W	5-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	19-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	21-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	23-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	27-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AG	29-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AH	1-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AL	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AM	15-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AN	17-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AO	19-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AP	21-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AQ	23-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AR	27-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AS	29-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AT	31-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AU	33-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

11 C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007602 7/2


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T1Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 3 Oct 2019 Mitek Industries, Inc. Tue Apr 20 09:00:05 2020 Page 1

ID:DMCubINVR6TsFoe31v6I zns11-nyhMNBKcAvHcPQKTuoDRWDoscNkApnRqDRR2zMFile

1-3.8 0-0 4-0-10 4-0-10 5-3-4 7-3-4 9-3-12 5-5-12 14-9-8 17-7-0 20-4-8 25-10-4 31-1-6 35-2-0 38-5-8
Scale = 1:57.8

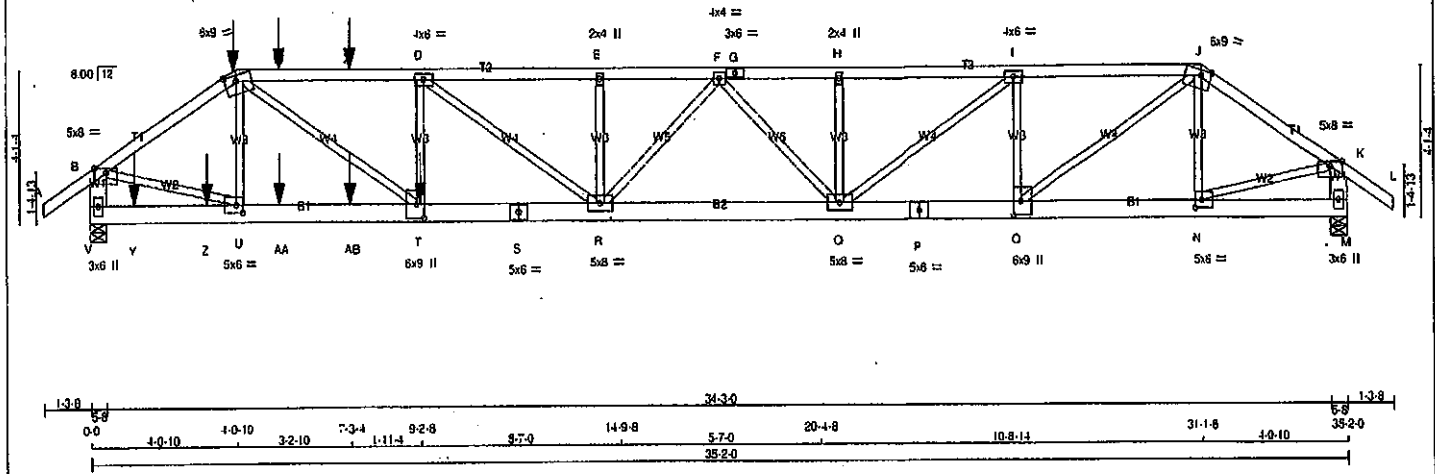

TOTAL WEIGHT = 2 X 161 = 323 lb

LUMBER						
N. L. G. A. RULES						
CHORDS		SIZE	LUMBER		DESCR	
A - C	2x4	DRY	No.2		9PF	
C - G	2x4	DRY	No.2		9PF	
G - J	2x4	DRY	No.2		9PF	
J - L	2x4	DRY	No.2		9PF	
V - B	2x6	DRY	No.2		9PF	
M - K	2x6	DRY	No.2		9PF	
V - S	2x6	DRY	No.2		9PF	
S - P	2x6	DRY	No.2		9PF	
P - M	2x6	DRY	No.2		9PF	
ALL WEBS		2x3	DRY	No.2		SPF
EXCEPT						

DRY, SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122'X3') SPIRAL NAILS		
A - C	12	SIDE(61.0)
C - G	12	SIDE(61.0)
G - J	12	TOP
J - L	12	TOP
V - B	12	TOP
M - K	12	TOP
BOTTOM CHORDS: (0.122'X3') SPIRAL NAILS		
V - S	12	SIDE(183.1)
S - P	12	TOP
P - M	12	TOP
WEBS: (0.122'X3') SPIRAL NAILS		
2x3	8	SIDE(385.4)
D - T	4	
I - O	4	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG
V	VERT	HORIZ	UPLIFT	IN-SX
M	4215 0	4215 0	0 0	5-8 5-8

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM LIVE WIND DEAD SOIL
V	2974	1987 0 0 0 0 0 0 0 0 0 0
M	1921	1283 0 0 0 0 0 0 0 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING		TOTAL LOAD CASES: (4)									
CHORDS					W E B S						
MAX. FACTORED		FACTORED			MAX. FACTORED		MAX. FACTORED				
MEMB.	FORCE	VERT. LOAD	MAX	MAX.	MEMB.	FORCE	MAX				
(LBS)	(PLF)	CSI (LC)	UNBRAC	LENGTH	(LBS)	CSI (LC)					
FR-TO	FROM TO	LENGTH	FR-TO								
A-B	0 35	-91.8 -91.8 0.07 (1)	10.00	U-C	-783 0	0.10 (1)					
B-C	-5115 0	-91.8 -91.8 0.28 (1)	4.07	C-T	0 4817	0.60 (1)					
C-W	-8135 0	-91.8 -91.8 0.84 (1)	3.00	T-D	-622 0	0.08 (1)					
W-X	-8135 0	-91.8 -91.8 0.84 (1)	3.00	O-I	-1797 0	0.23 (1)					
X-D	-8135 0	-91.8 -91.8 0.84 (1)	3.00	C-J	0 3211	0.40 (1)					
D-E	-8108 0	-91.8 -91.8 0.59 (1)	3.05	N-J	-512 0	0.06 (1)					
E-F	-8108 0	-91.8 -91.8 0.32 (1)	3.28	B-U	0 4378	0.54 (1)					
F-G	-6928 0	-91.8 -91.8 0.28 (1)	3.57	N-K	0 2693	0.33 (1)					
G-H	-6928 0	-91.8 -91.8 0.28 (1)	3.57	Q-I	0 2133	0.26 (1)					
H-I	-6928 0	-91.8 -91.8 0.45 (1)	3.42	D-R	-37 24	0.01 (1)					
I-J	-5210 0	-91.8 -91.8 0.34 (1)	3.99	Q-H	-385 0	0.05 (1)					
J-K	-3153 0	-91.8 -91.8 0.19 (1)	5.04	R-E	-343 0	0.04 (1)					
K-L	0 35	-91.8 -91.8 0.07 (1)	10.00	R-F	0 692	0.09 (1)					
V-B	-1180 0	0.0 0.0 0.15 (1)	8.99	F-Q	-1081 0	0.23 (1)					
M-K	-2698 0	0.0 0.0 0.10 (1)	7.81								

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	HEEL	CONN.
C	4-0-10	-49	-55	---	---	FRONT	VERT	---	C1
C	4-0-10	-254	-254	---	---	FRONT	VERT	---	C1
T	9-2-6	-2179	-2179	---	---	BACK	VERT	---	C1
W	5-3-4	-110	-110	---	---	BACK	VERT	---	C1
X	7-3-4	-110	-110	---	---	BACK	VERT	---	C1
Y	1-3-4	-28	-28	---	---	BACK	VERT	---	C1
Z	3-3-4	-28	-28	---	---	BACK	VERT	---	C1
AA	5-3-4	-28	-28	---	---	BACK	VERT	---	C1
AB	7-3-4	-28	-28	---	---	BACK	VERT	---	C1

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.24')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/954 (0.44')

CSI: IC=0.64/1.00 (C-D:1), BC=0.61 1.00 (R-T:1), WB=0.60/1.00 (C-T:1), SS=0.17/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (J) (INPUT = 0.90)
JSI METAL = 0.77 (J) (INPUT = 1.00)



Structural component only
DWG# T-2007603 1/4

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T1Z	1	2	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:05 2020 Page 2

ID:DMCubjNVR6TstFoe31v6I zns1l-nyihMNBjKcAvHCpOKTuoORWDoscNkAonRqDRR2zMFie

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	8.0	Edge	
C TTWW-m	MT20	6.0	9.0	1.75	3.50
D TMVW-t	MT20	4.0	6.0		
E TMVW-w	MT20	2.0	4.0		
F TMVW-t	MT20	4.0	4.0		
G TS-t	MT20	3.0	6.0		
H TMVW-w	MT20	2.0	4.0		
I TMVW-t	MT20	4.0	6.0		
J TTWW-m	MT20	6.0	9.0	1.75	3.50
K TMVW-p	MT20	5.0	8.0	Edge	
M BMV1-p	MT20	3.0	6.0		
N BMVW-t	MT20	5.0	6.0	2.50	2.25
O BMVW-t	MT20	6.0	9.0	4.50	2.50
P BS-t	MT20	5.0	6.0		
Q BMVWW-t	MT20	5.0	8.0		
R BMVWW-t	MT20	6.0	8.0		
S BS-t	MT20	5.0	6.0		
T BMVW-t	MT20	6.0	9.0	4.50	2.50
U BMVW-t	MT20	5.0	6.0	2.50	2.25
V BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.





Structural component only
DWG# T-2007603 7/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T2	2	1	TRAUSS DESC.		

Taharack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:06 2020 Page 1

ID:DMCubINVR6TsiF0a31v6i zns1l-F8H4ajCx5wlrwM0cuAP1x2L0Gy5TgYwIU2? UzMFfId

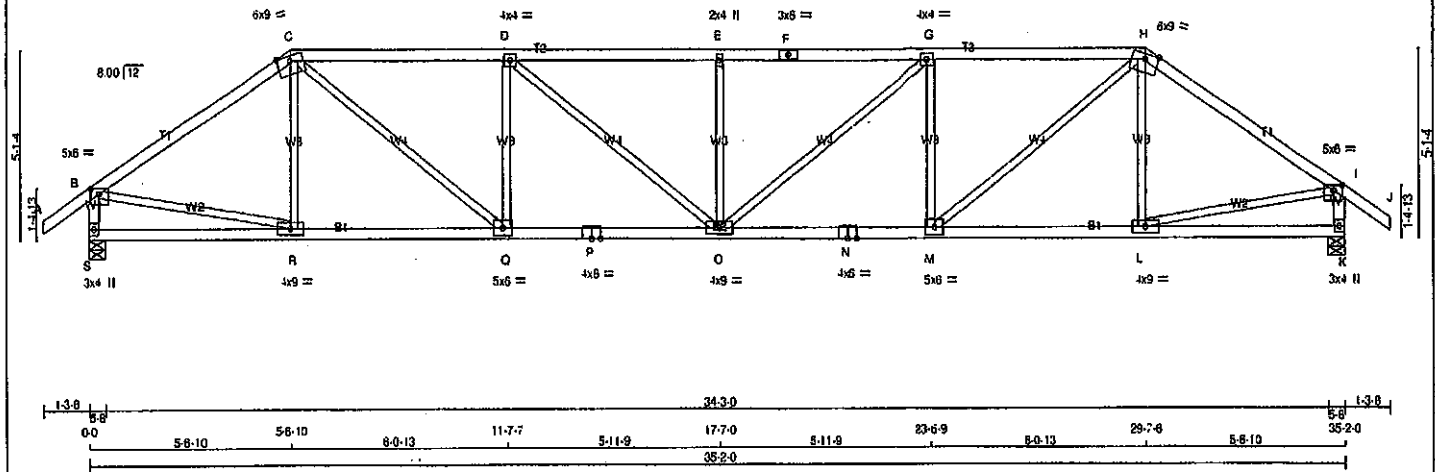

TOTAL WEIGHT = 2 X 140 = 280 lb

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N. L. G. A. RULES				
A - C	2x4	DRY	No.2	SPF
C - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - J	2x4	DRY	No.2	SPF
S - B	2x4	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF
S - P	2x4	DRY	No.2	SPF
P - N	2x4	DRY	No.2	SPF
N - K	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY, SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B TMW/p	MT20	5.0	6.0	1.75	2.75	
C TTW/w	MT20	6.0	9.0	Edge		
D TMW/w	MT20	4.0	4.0			
E TMW/w	MT20	2.0	4.0			
F TS-1	MT20	3.0	6.0			
G TMW/w	MT20	4.0	4.0			
H TTW/w	MT20	6.0	9.0	Edge		
I TMW/p	MT20	5.0	6.0	1.75	2.75	
K BMV1+p	MT20	3.0	4.0			
L BMW/w	MT20	4.0	9.0			
M BMW/w	MT20	5.0	6.0			
N BS-1	MT20	4.0	6.0			
O BMW/w	MT20	4.0	9.0			
P BS-1	MT20	4.0	6.0			
Q BMW/w	MT20	5.0	6.0			
R BMW/w	MT20	4.0	9.0			
S BMV1+p	MT20	3.0	4.0			

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		GROSS REACTION		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	BRG	IN-SX	BRG	IN-SX		
S	2085	0	2085	0	0	5-8	5-8				
K	2085	0	2085	0	0	5-8	5-8				

UNFACTORED REACTIONS							
1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SC
S	1458	970 0	0 0	0 0	0 0	488 0	0
K	1458	970 0	0 0	0 0	0 0	488 0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.97 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORZ. LOAD (LBS)
FR-TO			
A-B	0 35	-91.8 -91.8 0.12 (1)	10.00
B-C	-2298 0	-91.8 -91.8 0.70 (1)	3.78
C-D	-3213 0	-91.8 -91.8 0.80 (1)	3.19
D-E	-3594 0	-91.8 -91.8 0.88 (1)	2.97
E-F	-3594 0	-91.8 -91.8 0.88 (1)	2.97
F-G	-3594 0	-91.8 -91.8 0.88 (1)	2.97
G-H	-3213 0	-91.8 -91.8 0.80 (1)	3.19
H-I	-2298 0	-91.8 -91.8 0.70 (1)	3.78
I-J	0 35	-91.8 -91.8 0.12 (1)	10.00
S-B	-2023 0	0.0 0.0 0.21 (1)	5.94
K-I	-2023 0	0.0 0.0 0.21 (1)	5.94
S-R	0 0	-18.5 -18.5 0.15 (4)	10.00
R-Q	0 1903	-18.5 -18.5 0.30 (1)	10.00
O-P	0 3213	-18.5 -18.5 0.58 (1)	10.00
P-O	0 3213	-18.5 -18.5 0.58 (1)	10.00
O-N	0 3213	-18.5 -18.5 0.58 (1)	10.00
N-M	0 3213	-18.5 -18.5 0.68 (1)	10.00
M-L	0 1903	-18.5 -18.5 0.39 (1)	10.00
L-K	0 0	-18.5 -18.5 0.15 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 5.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CSI: TC=0.88(1.00) (D-E-1), 8C=0.58(1.00) (M-O-1), WB=0.44(1.00) (I-L-1), SSI=0.28(1.00) (G-H-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.67 (1) (INPUT = 0.90)
JSI METAL = 0.74 (1) (INPUT = 1.00)



Structural component only
DWG# T-2007604


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T3	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Metek Industries, Inc. Tue Apr 28 09:00:08 2020 Page 1

ID:DMCubINVR6TstFoe31v6l_zns11-F8H4ajCx5wlmvMOCuAP1xf2QrG_VTXHwIUz7_UzMFId

1-3.8 0.0 3-7.9 3-7.9 3-5.1 7-0-10 5-3-13 12-4-7 5-2-9 17-7-0 5-2-9 22-9-9 5-3-13 28-1-6 3-5-1 31-6-7 35-2-0 1-3-8
Scale = 1:57.6

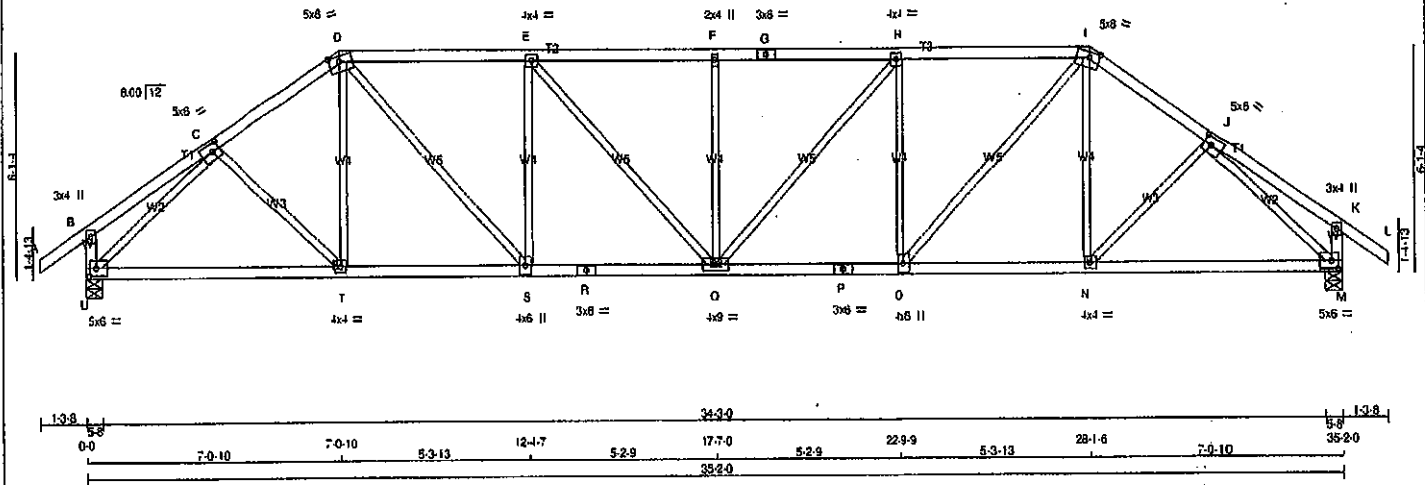

TOTAL WEIGHT = 2 X 151 = 303 lb (M)

LUMBER

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - G	2x4	DRY No.2	SPF
G - I	2x4	DRY No.2	SPF
I - L	2x4	DRY No.2	SPF
U - B	2x4	DRY No.2	SPF
M - K	2x4	DRY No.2	SPF
U - R	2x4	DRY No.2	SPF
R - P	2x4	DRY No.2	SPF
P - M	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW+1	MT20	5.0	6.0	2.50	2.50
D	TTWV+m	MT20	5.0	6.0	1.75	3.50
E	TMVW+1	MT20	4.0	4.0		
F	TMVW+1	MT20	2.0	4.0		
G	TS-1	MT20	3.0	6.0		
H	TMVW+1	MT20	4.0	4.0		
I	TTWV+m	MT20	5.0	6.0	1.75	3.50
J	TMVW+1	MT20	5.0	6.0	2.50	2.50
K	TMV+p	MT20	3.0	4.0		
M	BMVW+1	MT20	5.0	6.0	2.50	2.25
N	BMVW+1	MT20	4.0	4.0		
O	BMVW+1	MT20	4.0	6.0		
P	BS-1	MT20	3.0	6.0		
Q	BMVW+1	MT20	4.0	9.0		
R	BS-1	MT20	3.0	6.0		
S	BMVW+1	MT20	4.0	6.0		
T	BMVW+1	MT20	4.0	4.0		
U	BMVW+1	MT20	5.0	6.0	2.50	2.25

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	RECORD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
U	2085	0	2085	0	5-8	5-8
M	2085	0	2085	0	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
U	1458	970.0	0.0	0.0	0.0	485.0	0.0
M	1458	970.0	0.0	0.0	0.0	485.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.53 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO				FR-TO			
A-B	0 35	-91.8	-91.8 0.12 (1)	10.00	C-T	0 135	0.03 (4)
B-C	0 18	-91.8	-91.8 0.16 (1)	10.00	T-D	0 90	0.03 (4)
C-D	-2306 0	-91.8	-91.8 0.23 (1)	4.31	D-S	0 1218	0.27 (1)
D-E	-2723 0	-91.8	-91.8 0.54 (1)	3.69	S-E	-814 0	0.48 (1)
E-F	-2868 0	-91.8	-91.8 0.58 (1)	3.53	E-Q	0 363	0.08 (1)
F-G	-2868 0	-91.8	-91.8 0.58 (1)	3.53	Q-F	-440 0	0.26 (1)
G-H	-2868 0	-91.8	-91.8 0.58 (1)	3.53	Q-H	0 363	0.08 (1)
H-I	-2723 0	-91.8	-91.8 0.54 (1)	3.69	O-H	-814 0	0.48 (1)
I-J	-2306 0	-91.8	-91.8 0.23 (1)	4.31	O-I	0 1218	0.27 (1)
J-K	0 18	-91.8	-91.8 0.16 (1)	10.00	N-I	0 90	0.03 (4)
K-L	0 35	-91.8	-91.8 0.12 (1)	10.00	N-J	0 135	0.03 (4)
U-B	-255 0	0.0	0.0 0.03 (1)	7.81	U-C	-2514 0	0.97 (1)
M-K	-255 0	0.0	0.0 0.03 (1)	7.81	J-M	-2514 0	0.97 (1)
U-T	0 1801	-18.5	-18.5 0.40 (1)	10.00			
T-S	0 1900	-18.5	-18.5 0.41 (1)	10.00			
S-R	0 2723	-18.5	-18.5 0.49 (1)	10.00			
R-Q	0 2723	-18.5	-18.5 0.49 (1)	10.00			
Q-P	0 2723	-18.5	-18.5 0.49 (1)	10.00			
P-O	0 2723	-18.5	-18.5 0.49 (1)	10.00			
O-N	0 1900	-18.5	-18.5 0.41 (1)	10.00			
N-M	0 1801	-18.5	-18.5 0.40 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.16")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.29")

CSI: TC=0.58/1.00 (E-F:1), BC=0.49/1.00 (O-Q:1), WB=0.97/1.00 (J-M:1), SS=0.23/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP/DRY/ SHEAR SECTION
(PSI) (PL) (PLD)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (M) (INPUT = 0.90)
JSI METAL = 0.84 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007605


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T4	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 3.310 5 Oct 2018 Mitek Industries, Inc. Tue Apr 28 08:00:07 2020 Page 1

ID:DMCubiNVR6TslFoe31v6l_zns11-lrSn2CzSdQdXWzSuzGTsbZlgK2C5T4u81YVWwzMFic

1-3.8 0.0 1-1.9 1-1.9 0-6-10 2-0-11 14-7-5 5-11-7 20-6-11 6-0-11 28-7-6 4-2-1 30-9-7 4-1-9 35-2-0 35-2-0 1-3-8
Scale = 1:57.6

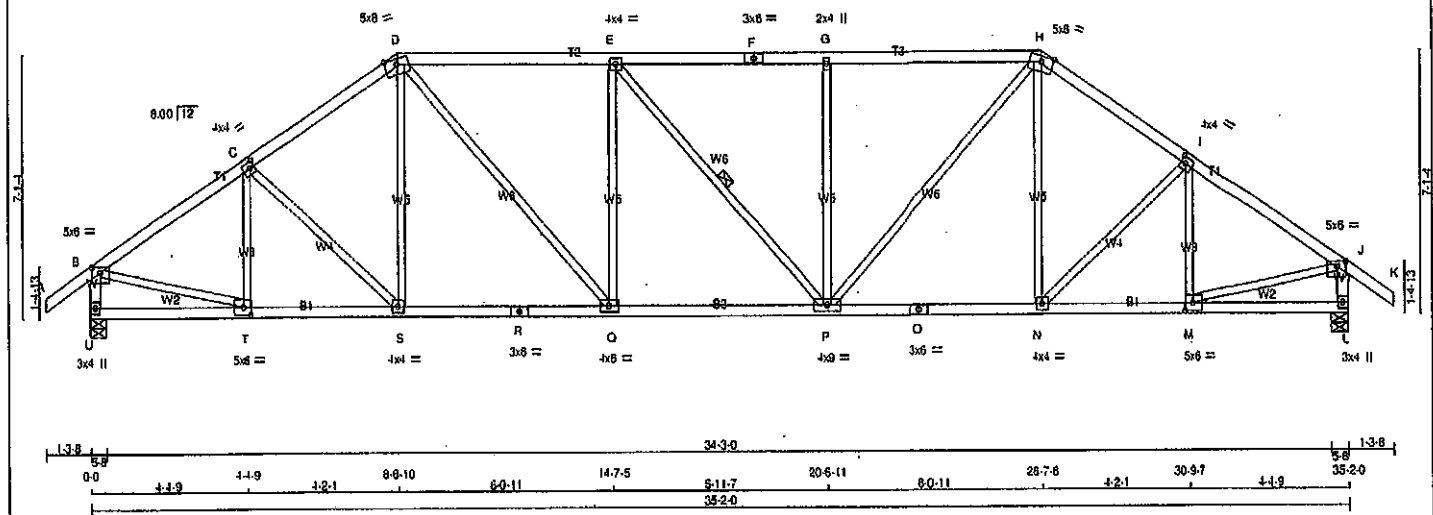

TOTAL WEIGHT = 2 X 155 = 309 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
E - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - K	2x4	DRY	No.2	SPF	
L - B	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
U - R	2x4	DRY	No.2	SPF	
R - O	2x4	DRY	No.2	SPF	
O - L	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (tablets in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	6.0	1.75	2.75		
C TMWW-l	MT20	4.0	4.0	2.00	1.50		
D TTWW-m	MT20	5.0	8.0	Edge			
E TMWW-l	MT20	4.0	4.0				
F TS-l	MT20	3.0	6.0				
G TMW-w	MT20	2.0	4.0				
H TTWW-m	MT20	5.0	8.0	Edge			
I TMWW-l	MT20	4.0	4.0	2.00	1.50		
J TMVW-p	MT20	5.0	8.0	1.75	2.75		
L BMV-l-p	MT20	3.0	4.0				
M BMWW-l	MT20	5.0	6.0	2.50	2.75		
N BMWW-l	MT20	4.0	4.0				
O SS-l	MT20	3.0	6.0				
P BMWW-l	MT20	4.0	9.0				
Q BMWW-l	MT20	4.0	6.0				
R SS-l	MT20	3.0	8.0				
S BMWW-l	MT20	4.0	4.0				
T BMWW-l	MT20	5.0	6.0	2.50	2.75		
U BMV-l-p	MT20	3.0	4.0				

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	HORZ	GROSS REACTION	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG
U	2065	0	2065	0	0	0	5-8	5-8	5-8
L	2065	0	2065	0	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
U	1458	970.0	0.0	0.0	0.0	488.0	0.0
L	1458	970.0	0.0	0.0	0.0	488.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1.2 LENGTH OF E-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 (PLP)	MAX. CS1 (LC)	UNBRAC	MEMB.	FORCE (LBS)	MAX. CS1 (LC)	UNBRAC
FR-TO						FR-TO			
A-B	0 35	-91.8	-91.8	0.12 (1)	10.00	T-C	-397 0	0.11 (1)	
B-C	-2289 0	-91.8	-91.8	0.37 (1)	4.19	C-S	-78 0	0.05 (1)	
C-D	-2254 0	-91.8	-91.8	0.36 (1)	4.21	S-D	0 155	0.04 (4)	
D-E	-2485 0	-91.8	-91.8	0.84 (1)	3.72	D-Q	0 949	0.21 (1)	
E-F	-2483 0	-91.8	-91.8	0.84 (1)	3.72	Q-E	-597 0	0.52 (1)	
F-G	-2483 0	-91.8	-91.8	0.84 (1)	3.72	E-P	-2 0	0.00 (1)	
G-H	-2483 0	-91.8	-91.8	0.83 (1)	3.74	P-G	-597 0	0.52 (1)	
H-I	-2254 0	-91.8	-91.8	0.36 (1)	4.21	P-H	0 947	0.21 (1)	
I-J	-2289 0	-91.8	-91.8	0.37 (1)	4.19	H-N	0 157	0.04 (4)	
J-K	0 35	-91.8	-91.8	0.12 (1)	10.00	N-I	-78 0	0.05 (1)	
U-B	-2027 0	0.0	0.0	0.21 (1)	5.94	M-I	-397 0	0.11 (1)	
L-J	-2026 0	0.0	0.0	0.21 (1)	5.94	B-T	0 1965	0.44 (1)	
						M-J	0 1965	0.44 (1)	
U-T	0 0	-18.5	-18.5	0.08 (4)	10.00				
T-S	0 1908	-18.5	-18.5	0.37 (1)	10.00				
S-R	0 1853	-18.5	-18.5	0.36 (1)	10.00				
R-Q	0 1853	-18.5	-18.5	0.36 (1)	10.00				
Q-P	0 2485	-18.5	-18.5	0.47 (1)	10.00				
P-O	0 1854	-18.5	-18.5	0.36 (1)	10.00				
O-N	0 1854	-18.5	-18.5	0.36 (1)	10.00				
N-M	0 1908	-18.5	-18.5	0.37 (1)	10.00				
M-L	0 0	-18.5	-18.5	0.08 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	8.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17')

CALCULATED VERT. DEFL. (LL) = L/999 (0.12')

ALLOWABLE DEFL. (TL) = L/360 (1.17')

CALCULATED VERT. DEFL. (TL) = L/999 (0.24')

CS1: TC=0.64/1.00 (D-E:1), BC=0.47/1.00 (P-Q:1),

WB=0.52/1.00 (E-Q:1), SS1=0.26/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS SEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (0) INPUT = 0.90

JSI METAL= 0.62 (0) INPUT = 1.00



Structural component only
DWG# T-2007606

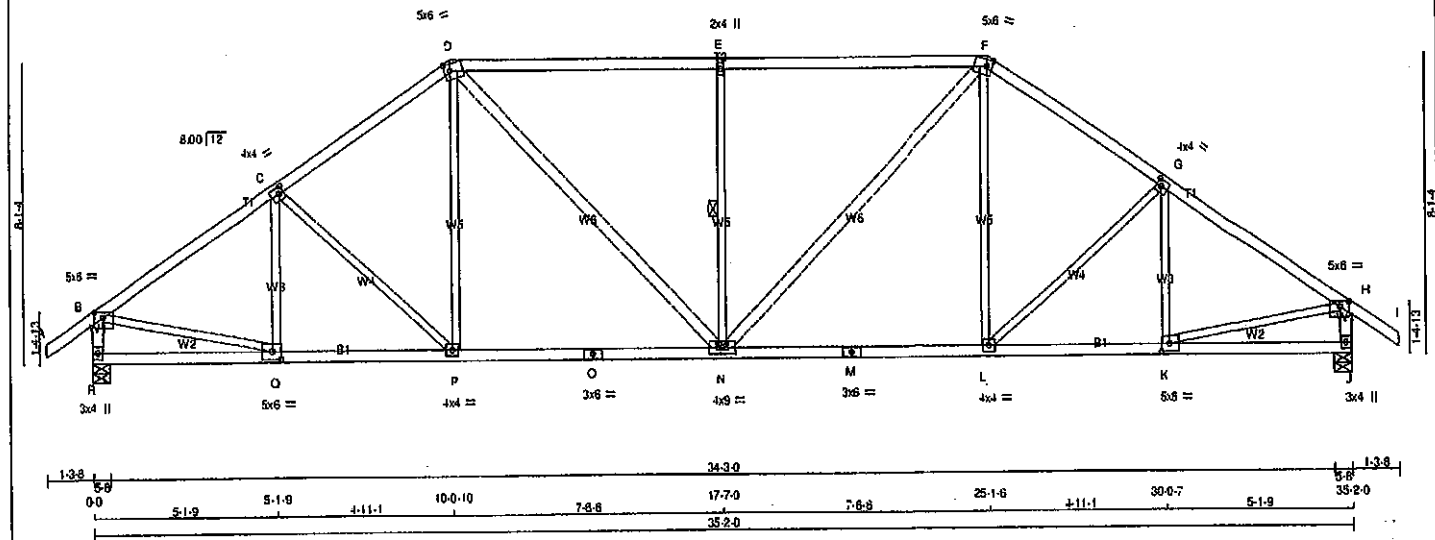

TOTAL WEIGHT = 2 X 158 = 317 lb

LUMBER
 N. L. G. A. RULES
 CHORDS SIZE LUMBER DESCR.
 A - D 2x4 DRY No.2 SPF
 D - F 2x4 DRY No.2 SPF
 F - I 2x4 DRY No.2 SPF
 I - B 2x4 DRY No.2 SPF
 B - H 2x4 DRY No.2 SPF
 H - O 2x4 DRY No.2 SPF
 O - M 2x4 DRY No.2 SPF
 M - J 2x4 DRY No.2 SPF
 ALL WEBS 2x3 DRY No.2 SPF
 EXCEPT
 D - N 2x4 DRY No.2 SPF
 N - F 2x4 DRY No.2 SPF
 DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
R	2065	0	2065	0	5-8	5-8
J	2065	0	2065	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
R	1458	970	0	0	0	488	0
J	1458	970	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED W THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
 TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		MAX. UNBRACED LENGTH	FR-TO	MEMB.	WEBS		MAX. UNBRACED LENGTH	FR-TO
	MAX. FACTORED FORCE (LBS)	VERT. LOAD (LBS)	VERT. LOAD (LBS)	MAX. CS (LBS)				MAX. FACTORED FORCE (LBS)	MAX. CS (LBS)		
A-B	0	35	-91.8	-91.8	0.12 (1)	10.00	C-P	-321	0	0.11 (1)	10.00
B-C	-2317	0	-91.8	-91.8	0.38 (1)	4.16	P-D	-218	0	0.18 (1)	10.00
C-D	-2185	0	-91.8	-91.8	0.37 (1)	4.28	D-N	0	266	0.06 (1)	10.00
D-E	-2274	0	-91.8	-91.8	0.81 (1)	3.47	N-E	0	691	0.11 (1)	10.00
E-F	-2274	0	-91.8	-91.8	0.81 (1)	3.47	E-F	0	691	0.35 (1)	10.00
F-G	-2185	0	-91.8	-91.8	0.37 (1)	4.28	N-F	0	691	0.11 (1)	10.00
G-H	-2317	0	-91.8	-91.8	0.38 (1)	4.16	L-F	0	266	0.06 (1)	10.00
H-I	0	35	-91.8	-91.8	0.12 (1)	10.00	L-G	-218	0	0.18 (1)	10.00
I-J	-2022	0	0.0	0.0	0.21 (1)	5.84	K-G	-321	0	0.11 (1)	10.00
J-K	-2022	0	0.0	0.0	0.21 (1)	5.84	B-Q	0	1955	0.45 (1)	10.00
K-L	0	0	-18.5	-18.5	0.10 (4)	10.00	K-H	0	1955	0.45 (1)	10.00
L-O	0	0	-18.5	-18.5	0.40 (1)	10.00					
O-P	0	1794	-18.5	-18.5	0.41 (1)	10.00					
P-Q	0	1794	-18.5	-18.5	0.41 (1)	10.00					
Q-N	0	1794	-18.5	-18.5	0.41 (1)	10.00					
N-M	0	1794	-18.5	-18.5	0.41 (1)	10.00					
M-L	0	1794	-18.5	-18.5	0.41 (1)	10.00					
L-K	0	1953	-18.5	-18.5	0.40 (1)	10.00					
K-J	0	0	-18.5	-18.5	0.10 (4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
 CALCULATED VERT. DEFL.(LL) = L/999 (0.11)
 ALLOWABLE DEFL.(TL) = L/360 (1.17)
 CALCULATED VERT. DEFL.(TL) = L/999 (0.22)

CSL TC=0.81.1.00 (E-F:1), BC=0.41.1.00 (L-N:1), WB=0.45.1.00 (H-K:1), SS=0.34.1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLD) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1887 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.87 (H) (INPUT = 0.90)
 JSI METAL = 0.64 (M) (INPUT = 1.00)

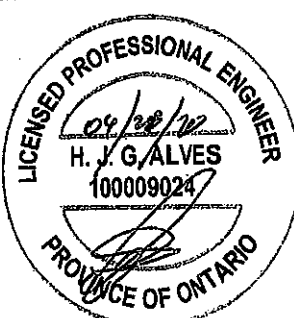

Structural component only
 DWG# T-2007607

JOB NAME 408222	TRUSS NAME T6	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 3.310 S Oct 29 2019 M/Tek Industries, Inc. Tue Apr 28 09:00:09 2020 Page 1
 ID:DMCubINVR6TstFos31v6l_zns11-ijyCCkEpOrgLmp6BZlykZHqkU0ng01MLSB/apzMFia
 35-20 35-5-8
 Scale = 1:57.6

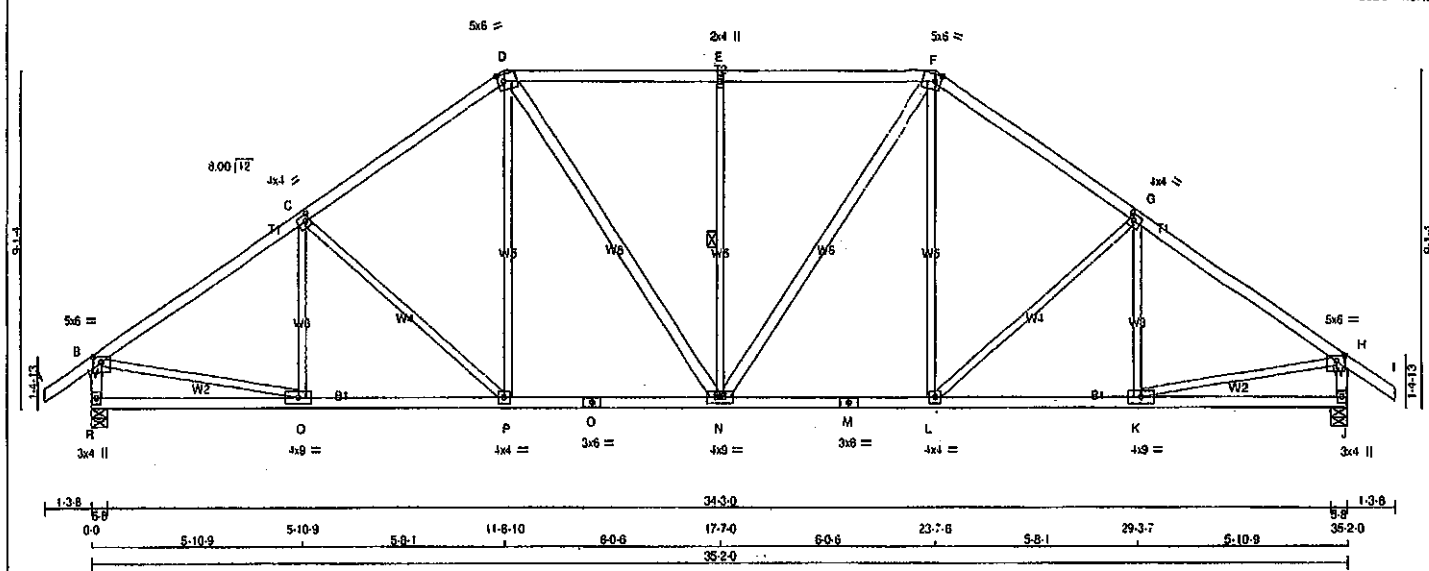

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
EXCEPT			
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2
DRY, SEASONED LUMBER.			

PLATES (table in inches)				
JT TYPE	PLATES	W.	LEN	Y X
B	TMVW-p	MT20	5.0	6.0 1.75 2.75
C	TMVW-l	MT20	4.0	4.0 2.00 1.50
D	TTWW-m	MT20	5.0	6.0 2.25 2.00
E	TMVW-w	MT20	2.0	4.0
F	TTWW-m	MT20	5.0	6.0 2.25 2.00
G	TMVW-l	MT20	4.0	4.0 2.00 1.50
H	TMVW-p	MT20	5.0	6.0 1.75 2.75
J	BMV1+p	MT20	3.0	4.0
K	BMVW-l	MT20	4.0	9.0
L	BMVW-l	MT20	4.0	4.0
M	BS-l	MT20	3.0	6.0
N	BMVW-w	MT20	4.0	9.0
O	BS-l	MT20	3.0	6.0
P	BMVW-l	MT20	4.0	4.0
Q	BMVW-l	MT20	4.0	9.0
R	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
		FACTORED		GROSS REACTION		INPUT		REQD	
JT	VERT	DOWN	HORIZ	DOWN	HORIZ	BRG	IN-SX	BRG	IN-SX
R	2085	0	2085	0	0	5-8	5-8		
J	2085	0	2085	0	0	5-8	5-8		
UNFACTORED REACTIONS									
		1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
R	1458	970	0	0-0	0-0	0-0	488	0	0
J	1458	970	0	0-0	0-0	0-0	488	0	0
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J									
BRACING									
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.99 FT.									
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.									
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.									
1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.									
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW									
LOADING									
TOTAL LOAD CASES: (4)									
		CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)		
FR-TO		FROM	TO		FR-TO				
A-B	0-35	-91.8	-91.8 0.12 (1)	10.00	Q-C	-249	11	0.11 (1)	
B-C	-2348	0	-91.8 -91.8 0.52 (1)	3.99	C-P	-356	0	0.42 (1)	
C-D	-2095	0	-91.8 -91.8 0.46 (1)	4.22	P-D	0	341	0.08 (1)	
D-E	-1985	0	-91.8 -91.8 0.49 (1)	4.26	D-N	0	477	0.08 (1)	
E-F	-1985	0	-91.8 -91.8 0.49 (1)	4.28	N-E	-678	0	0.37 (1)	
F-G	-2095	0	-91.8 -91.8 0.46 (1)	4.22	N-F	0	477	0.08 (1)	
G-H	-2348	0	-91.8 -91.8 0.52 (1)	3.99	L-F	0	341	0.08 (1)	
H-I	0-35	-91.8	-91.8 0.12 (1)	10.00	L-G	-356	0	0.42 (1)	
R-B	-2018	0	0.0 0.0 0.21 (1)	5.94	K-G	-249	11	0.11 (1)	
J-H	-2018	0	0.0 0.0 0.21 (1)	5.94	B-Q	0	2014	0.45 (1)	
					K-H	0	2014	0.45 (1)	
R-Q	0	0	-18.5 -18.5 0.14 (4)	10.00					
Q-P	0	1980	-18.5 -18.5 0.39 (1)	10.00					
P-O	0	1718	-18.5 -18.5 0.34 (1)	10.00					
O-N	0	1718	-18.5 -18.5 0.34 (1)	10.00					
N-M	0	1718	-18.5 -18.5 0.34 (1)	10.00					
M-L	0	1718	-18.5 -18.5 0.34 (1)	10.00					
L-K	0	1981	-18.5 -18.5 0.39 (1)	10.00					
K-J	0	0	-18.5 -18.5 0.14 (4)	10.00					

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL =	25.6 PSF
DL =	6.0 PSF
BOT CH. LL =	0.0 PSF
DL =	7.4 PSF
TOTAL LOAD =	39.0 PSF
SPACING = 24.0 IN. CG	
LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12	
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015	
THIS DESIGN COMPLIES WITH:	
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019	
- PART 9 OF OBC 2012 (2019 AMENDMENT)	
- CSA 086-09, CSA 088-14	
- TPIC 2011, TPIC 2014	
155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.8 P.S.F. SPECIFIED ROOF LIVE LOAD	
ALLOWABLE DEFL.(LL) = L/360 (1.17')	
CALCULATED VERT. DEFL.(LL) = L/999 (0.10')	
ALLOWABLE DEFL.(TL) = L/360 (1.17')	
CALCULATED VERT. DEFL.(TL) = L/999 (0.19')	
CSI: TC=0.52/1.00 (G-H:1), BC=0.39/1.00 (K-L:1), WB=0.45/1.00 (H-K:1), SS=0.27/1.00 (D-E:1)	
DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10	
COMP=1.10 SHEAR=1.10 TENS=1.10	
COMPANION LIVE LOAD FACTOR = 1.00	
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.	
NAIL VALUES	
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)	
MAX MIN MAX MIN MAX MIN	
MT20	618 354 1667 788 1907 1656
PLATE PLACEMENT TOL. = 0.250 inches	
PLATE ROTATION TOL. = 5.0 Deg.	
JSI GRIP= 0.87 (H) (INPUT = 0.90)	
JSI METAL= 0.56 (M) (INPUT = 1.00)	




Structural component only
 DWG# T-2007808

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T7	6	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:00:10 2020 Page 1

ID:DMCubINVR6TstFoe31v6l_zns1l-7wWp4FR98oCOzh070Uz5VD4qIMXPTGWA6xC7FzMFIZ

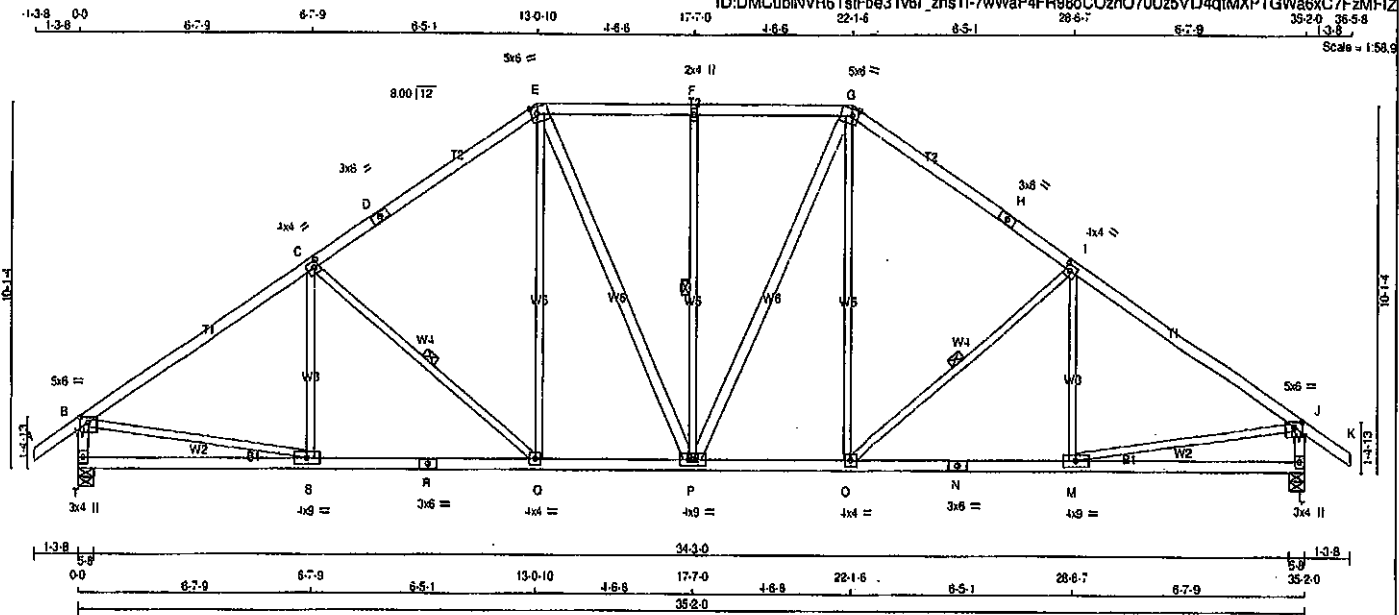

TOTAL WEIGHT = 6 X 172 = 1030 lb (M/F)

LUMBER	SIZE	DRY	LUMBER	DESCR.
CHOIRS				
A - D	2x4	DRY	No.2	SPF
E - H	2x4	DRY	No.2	SPF
I - L	2x4	DRY	No.2	SPF
M - P	2x4	DRY	No.2	SPF
Q - R	2x4	DRY	No.2	SPF
S - T	2x4	DRY	No.2	SPF
U - V	2x4	DRY	No.2	SPF
W - X	2x4	DRY	No.2	SPF
Y - Z	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
E - P	2x4	DRY	No.2	SPF
P - G	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

REACTIONS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UPLIFT	IN-SX
T	2085 0	2085 0	0 0	5-8 5-8
L	2085 0	2085 0	0 0	5-8 5-8

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
JT	COMBINED SNOW	LIVE	PERM. LIVE	
T	1458 970 0	0 0	0 0	488 0
L	1458 970 0	0 0	0 0	488 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1:2 LENGTH OF C-Q, F-P, I-Q.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LBS)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LBS)	
FR-TO		FROM TO			FR-TO			
A-B	0 35	-91.8	-91.8	0.12 (1)	10.00	S-C	-189 46	0.10 (1)
B-C	-2358 0	-91.8	-91.8	0.89 (1)	3.77	C-Q	-484 0	0.24 (1)
C-D	-1996 0	-91.8	-91.8	0.82 (1)	4.11	Q-E	0 415	0.09 (1)
D-E	-1996 0	-91.8	-91.8	0.82 (1)	4.11	E-P	0 315	0.05 (1)
E-F	-1761 0	-91.8	-91.8	0.27 (1)	4.77	P-F	-502 0	0.35 (1)
F-G	-1761 0	-91.8	-91.8	0.27 (1)	4.77	P-G	0 315	0.05 (1)
G-H	-1996 0	-91.8	-91.8	0.82 (1)	4.11	O-G	0 415	0.09 (1)
H-I	-1996 0	-91.8	-91.8	0.82 (1)	4.11	O-I	-484 0	0.24 (1)
I-J	-2358 0	-91.8	-91.8	0.89 (1)	3.77	M-I	-189 46	0.10 (1)
J-K	0 35	-91.8	-91.8	0.12 (1)	10.00	B-S	0 2021	0.45 (1)
T-B	-2014 0	0.0	0.0	0.21 (1)	5.95	M-J	0 2021	0.45 (1)
L-J	-2014 0	0.0	0.0	0.21 (1)	5.95			
T-S	0 0	-18.5	-18.5	0.19 (4)	10.00			
S-R	0 1995	-18.5	-18.5	0.42 (1)	10.00			
R-Q	0 1995	-18.5	-18.5	0.42 (1)	10.00			
Q-P	0 1629	-18.5	-18.5	0.32 (1)	10.00			
P-O	0 1629	-18.5	-18.5	0.32 (1)	10.00			
O-N	0 1995	-18.5	-18.5	0.42 (1)	10.00			
N-M	0 1995	-18.5	-18.5	0.42 (1)	10.00			
M-L	0 0	-18.5	-18.5	0.19 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.09')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.16')

CS: TC=0.69/1.00 (I-J:1), BC=0.42/1.00 (M-O:1), WB=0.45/1.00 (J-M:1), SS=0.24/1.00 (J-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	618	354	1087
	1087	786	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.87 (J) (INPUT = 0.90)
JSI METAL=0.87 (N) (INPUT = 1.00)




Structural component only
DWG# T-2007609

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T8	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 28 2019 AMETEK Industries, Inc. Tue Apr 28 09:00:10 2020 Page 1

ID:DMCubINVR6TsiFoe31v6I_zns11-7wWap4FR98oCOzhO70Uz5VD1gIM2PTQWae6xC7FzMF1Z

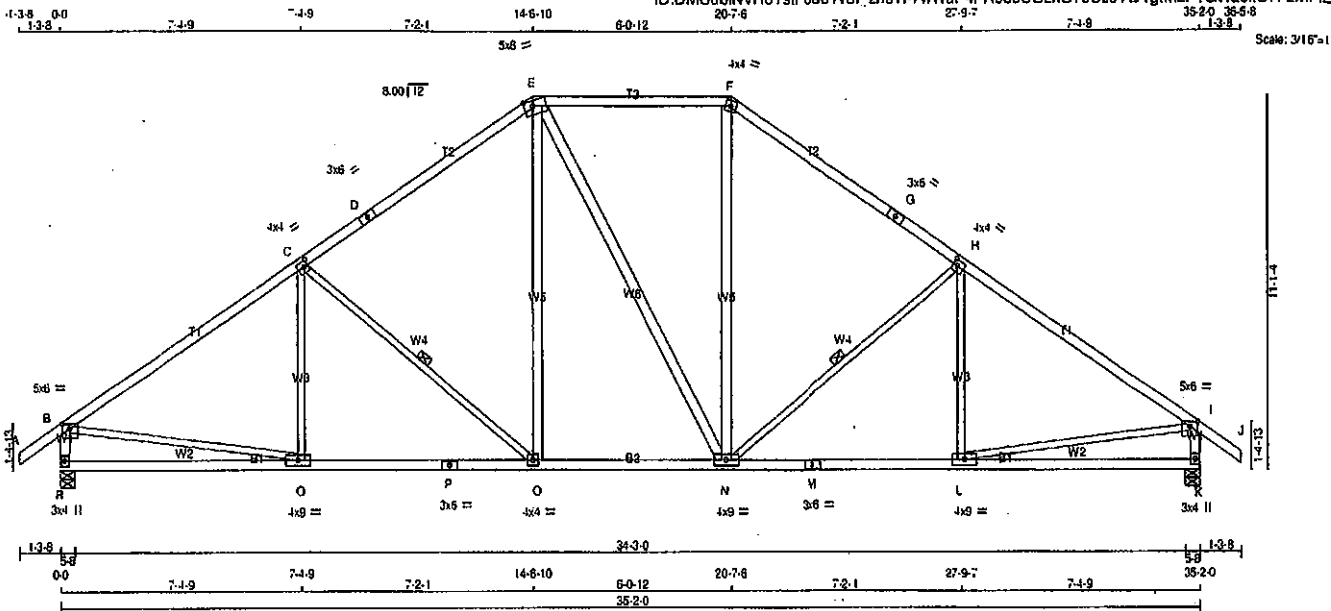

TOTAL WEIGHT = 2 X 166 = 333 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
F - G	2x4	DRY	No.2	SPF
G - J	2x4	DRY	No.2	SPF
R - B	2x4	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF
R - P	2x4	DRY	No.2	SPF
P - M	2x4	DRY	No.2	SPF
M - K	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
O - E	2x4	DRY	No.2	SPF
E - N	2x4	DRY	No.2	SPF
N - F	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	6.0	1.75	2.75
C TMVW-l	MT20	4.0	4.0	2.00	1.50
D TS-l	MT20	3.0	6.0		
E TTVW-m	MT20	5.0	6.0	2.00	3.00
F TTVW-m	MT20	4.0	4.0		
G TS-l	MT20	3.0	6.0		
H TMVW-l	MT20	4.0	4.0	2.00	1.50
I TMVW-p	MT20	5.0	6.0	1.75	2.75
K BMV-l	MT20	3.0	4.0		
L BMVW-l	MT20	4.0	9.0		
M BS-l	MT20	3.0	6.0		
N BMVW-l	MT20	4.0	9.0		
O BMVW-l	MT20	4.0	4.0		
P BS-l	MT20	3.0	6.0		
Q BMVW-l	MT20	4.0	9.0		
R BMV-l	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT VERT				
R	2085	0	0	5-8
K	2085	0	0	5-8

UNFACTORED REACTIONS

	1ST CASE	MAX. MIN. COMPONENT REACTIONS						
R	1458	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
K	1458	970	0	0	0	488	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.45 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-O, H-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC) UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO				FR-TO			
A-B	0 35	-91.8	-91.8 0.12 (1)	10.00	Q-C	-140 76	0.09 (1)
B-C	-2357 0	-91.8	-91.8 0.89 (1)	3.45	C-O	-604 0	0.38 (1)
C-D	-1888 0	-91.8	-91.8 0.78 (1)	3.91	O-E	0 499	0.08 (1)
D-E	-1888 0	-91.8	-91.8 0.78 (1)	3.91	E-N	0 0	0.00 (1)
E-F	-1538 0	-91.8	-91.8 0.47 (1)	4.74	N-F	0 500	0.08 (1)
F-G	-1888 0	-91.8	-91.8 0.78 (1)	3.91	H-F	-604 0	0.38 (1)
G-H	-1888 0	-91.8	-91.8 0.78 (1)	3.91	L-H	-140 75	0.09 (1)
H-I	-2357 0	-91.8	-91.8 0.89 (1)	3.45	B-Q	0 2020	0.45 (1)
I-J	0 35	-91.8	-91.8 0.12 (1)	10.00	L-I	0 2019	0.45 (1)
R-B	-2009 0	0.0	0.0 0.21 (1)	5.95			
K-I	-2009 0	0.0	0.0 0.21 (1)	5.95			
R-Q	0 0	-18.5	-18.5 0.25 (4)	10.00			
Q-P	0 1998	-18.5	-18.5 0.45 (1)	10.00			
P-O	0 1998	-18.5	-18.5 0.45 (1)	10.00			
O-N	0 1538	-18.5	-18.5 0.33 (1)	10.00			
N-M	0 1998	-18.5	-18.5 0.45 (1)	10.00			
M-L	0 1998	-18.5	-18.5 0.45 (1)	10.00			
L-K	0 0	-18.5	-18.5 0.24 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.20")

CSI: TC=0.89(1.00) (B-C:1), BC=0.45(1.00) (O-Q:1),
WB=0.45(1.00) (B-Q:1), SS=0.27(1.00) (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN
MT20 618 354 1667 789 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (F) (INPUT = 0.90)
JSI METAL= 0.68 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007610

JOB NAME 408222	TRUSS NAME T9	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:11 2020 Page 1	

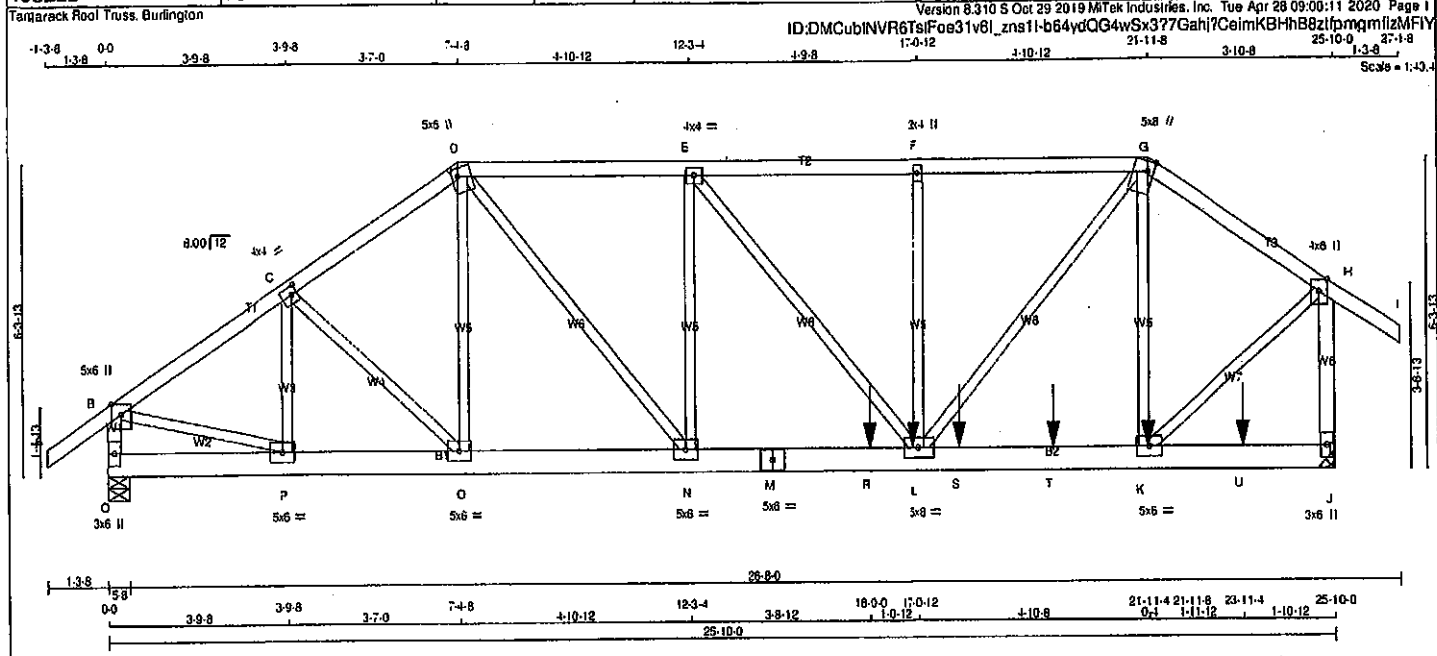

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
O - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
Q - M	2x6	DRY	No.2
M - J	2x6	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - D	12	TOP
D - G	12	TOP
G - I	12	TOP
O - B	12	TOP
J - H	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
Q - M	12	TOP
M - J	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	SIDE (183.11)

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	2236	2236	0	5-8
Q	3067	3067	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 4-0.

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED SNOW LIVE PERM. LIVE WIND DEAD SOIL
Q	1575 1085 0 0 0 0 510 0 0 0
J	2157 1479 0 0 0 0 878 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS) Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.97 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

CHORDS					WEBS				
MEMB.	MAX. FACTORED		FACTORED		MAX.	MEMB.	MAX. FACTORED		MAX.
	FORCE	VERT. LOAD	LCI	CS1 (LC)			FORCE	CS1 (LC)	
	(LBS)	(PLF)					(LBS)		
FR-TO		FROM	TO	LENGTH	FR-TO				
A-B	0 35	-91.8	-91.8	0.07 (1)	10.00	P-C	-503 0	0.06 (1)	
B-C	-2484 0	-91.8	-91.8	0.13 (1)	5.82	C-O	0 70	0.01 (1)	
C-D	-2571 0	-91.8	-91.8	0.13 (1)	5.83	O-D	-2 60	0.01 (4)	
D-E	-3030 0	-91.8	-91.8	0.20 (1)	5.11	D-N	0 1433	0.18 (1)	
E-F	-3235 0	-91.8	-91.8	0.21 (1)	4.97	N-E	-738 0	0.22 (1)	
F-G	-3235 0	-91.8	-91.8	0.20 (1)	4.99	E-L	0 327	0.04 (1)	
G-H	-2123 0	-91.8	-91.8	0.15 (1)	5.81	L-F	-169 0	0.14 (1)	
H-I	0 35	-91.8	-91.8	0.07 (1)	10.00	L-G	0 2339	0.29 (1)	
O-B	-2185 0	0.0	0.0	0.12 (1)	7.53	K-G	-995 0	0.30 (1)	
J-H	-2952 0	0.0	0.0	0.33 (1)	6.70	B-P	0 2137	0.28 (1)	
						K-H	0 2299	0.28 (1)	
Q-P	0 0	-18.5	-18.5	0.02 (1)	10.00				
P-O	0 2067	-18.5	-18.5	0.16 (1)	10.00				
O-N	0 2118	-18.5	-18.5	0.22 (1)	10.00				
N-M	0 3030	-18.5	-18.5	0.45 (1)	10.00				
M-R	0 3030	-18.5	-18.5	0.45 (1)	10.00				
R-L	0 3030	-18.5	-18.5	0.45 (1)	10.00				
L-S	0 1748	-18.5	-18.5	0.27 (1)	10.00				
S-T	0 1748	-18.5	-18.5	0.27 (1)	10.00				
T-K	0 1748	-18.5	-18.5	0.27 (1)	10.00				
K-U	0 0	-18.5	-18.5	0.08 (1)	10.00				
U-J	0 0	-18.5	-18.5	0.06 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
K	21-11-4	-187	-187	---	FRONT	VERT	TOTAL	---
L	16-11-4	-187	-187	---	FRONT	VERT	TOTAL	---
R	16-0-0	-1259	-1259	---	FRONT	VERT	TOTAL	---
S	17-11-4	-187	-187	---	FRONT	VERT	TOTAL	---
T	19-11-4	-187	-187	---	FRONT	VERT	TOTAL	---
U	23-11-4	-195	-195	---	FRONT	VERT	TOTAL	---

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.86")

CALCULATED VERT. DEFL. (LL) = L/999 (0.08")

ALLOWABLE DEFL. (TL) = L/360 (0.86")

CALCULATED VERT. DEFL. (TL) = L/999 (0.12")

CSI: TC=0.33/1.00 (H-J:1), BC=0.45/1.00 (L-N:1), WB=0.30/1.00 (G-K:1), SS=0.35/1.00 (L-N:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 518 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.81 (H) (INPUT = 0.80)

JSI METAL = 0.53 (H) (INPUT = 1.00)



Structural component only
DWG# T-2007611 '12

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRAWG NO.
408222	T9	1	2	TRUSS DESC.		

Tafnarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Tue Apr 26 09:00:11 2020 Page 2
ID:DMCubINVR6TsIFoe31v6I zns1I-b64vdQQ4wSx377Qahj?CeimKBHhB6ztfomgmfiZMFY

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	Edge	
C	TMWW-l	MT20	4.0	4.0	2.00	1.50
D	TTWW+m	MT20	5.0	6.0	2.00	1.50
E	TMWW-l	MT20	4.0	4.0		
F	TMW+w	MT20	2.0	4.0		
G	TTVW+m	MT20	5.0	8.0	2.50	1.50
H	TMVW+p	MT20	4.0	6.0	Edge	
J	BMVl+p	MT20	3.0	6.0		
K, N, O, P						
K	BMWW-l	MT20	5.0	6.0		
L	BMWWW-l	MT20	5.0	8.0		
M	BS-l	MT20	5.0	8.0		
Q	BMVl+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.




Structural component only
DWG# T-2007611

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T10	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:00:12 2020 Page 1

ID:DMCubINVR6TsFoe31v6I_zns11-4leLqmGihm3wdHmERWRawIUKh4GILtp2QQJBzMFIX

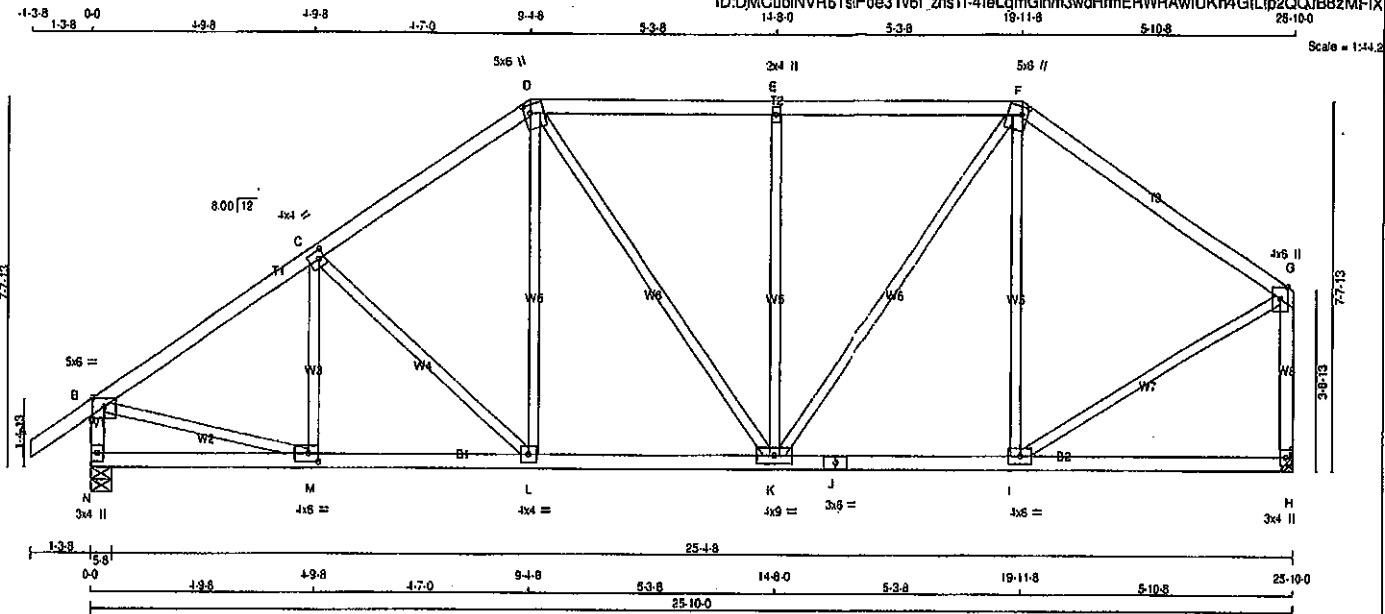

TOTAL WEIGHT = 118 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
N - B	2x4	DRY	No.2
H - G	2x4	DRY	No.2
N - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	8.0	Edge	
C TMVW-l	MT20	4.0	4.0	2.00	1.50
D TTWW+m	MT20	5.0	8.0	2.00	1.50
E TMVW-w	MT20	2.0	4.0		
F TTWW+m	MT20	5.0	8.0	2.00	1.50
G TMVW-p	MT20	4.0	6.0	Edge	
H BMV1+p	MT20	3.0	4.0		
I BMVW-l	MT20	4.0	6.0		
J BS-l	MT20	3.0	6.0		
K BMVWW-l	MT20	4.0	9.0		
L BMVW-l	MT20	4.0	4.0		
M BMVW-l	MT20	4.0	6.0	2.00	2.50
N BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
N	1550	0	1550	0
H	1424	0	1424	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3'-8".

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
N	1094	731	0	0	0	383	0
H	1007	661	0	0	0	346	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.93 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 35	-91.8 -91.8	0.12 (1)	10.00	M-C	-217 3	0.07 (1)
B-C	-1609 0	-91.8 -91.8	0.29 (1)	4.83	C-L	-273 0	0.20 (1)
C-D	-1425 0	-91.8 -91.8	0.28 (1)	5.17	L-D	0 280	0.08 (1)
D-E	-1272 0	-91.8 -91.8	0.35 (1)	5.30	D-K	0 185	0.04 (1)
E-F	-1272 0	-91.8 -91.8	0.35 (1)	5.30	K-E	-595 0	0.64 (1)
F-G	-1077 0	-91.8 -91.8	0.43 (1)	5.52	K-F	0 655	0.15 (1)
N-B	-1511 0	0.0 0.0	0.16 (1)	0.68	I-F	-390 0	0.42 (1)
H-G	-1380 0	0.0 0.0	0.32 (1)	0.92	B-M	0 1396	0.31 (1)
					I-G	0 1031	0.23 (1)
N-M	0 0	-18.5 -18.5	0.09 (4)	10.00			
M-L	0 1362	-18.5 -18.5	0.27 (1)	10.00			
L-K	0 1184	-18.5 -18.5	0.24 (1)	10.00			
K-J	0 890	-18.5 -18.5	0.23 (1)	10.00			
J-I	0 890	-18.5 -18.5	0.23 (1)	10.00			
I-H	0 0	-18.5 -18.5	0.15 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL:	25.6 PSF
DL	6.0 PSF
BOT CH. LL:	0.0 PSF
DL	7.4 PSF
TOTAL LOAD	39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.86")
CALCULATED VERT. DEFL. (LL) = L/999 (0.05")
ALLOWABLE DEFL. (TL) = L/360 (0.86")
CALCULATED VERT. DEFL. (TL) = L/999 (0.09")

CSL: TO=0.43/1.00 (F-G:1), BC=0.27/1.00 (L-M:1), WB=0.64/1.00 (E-K:1), SS=0.23/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (B) (INPUT = 0.90)

JSI METAL = 0.58 (G) (INPUT = 1.00)




Structural component only
DWG# T-2007612.

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T11A	2	1	TRUSS DESC.		

Tararack Roof Truss, Burlington

Version 8.310 S Oct 28 2019 Mitek Industries, Inc. Tue Apr 28 09:00:12 2020 Page 1

ID:DMCubINVR6TsIFoe31v6I zns1f-4feLqmGihm3wdHrmERWRAwIXHh2PIN5p2QQJB8zMFIX

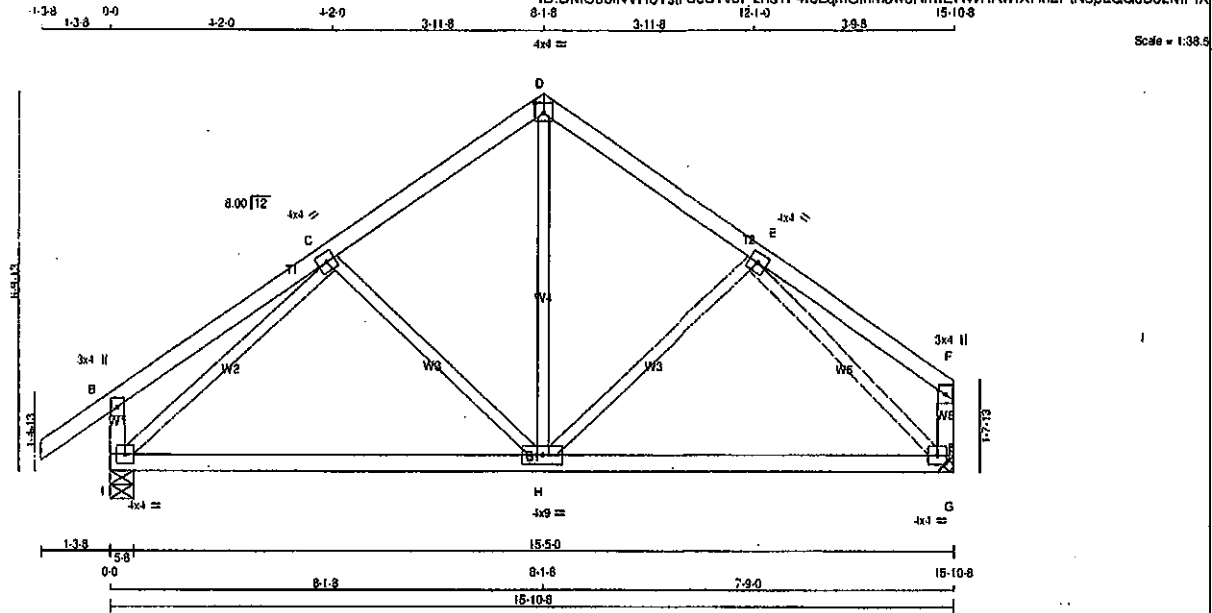

TOTAL WEIGHT = 2 X 68 = 133 lb [M/F]

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR
A - D	2x4	DRY	No.2		SPF
D - F	2x4	DRY	No.2		SPF
I - B	2x4	DRY	No.2		SPF
G - F	2x4	DRY	No.2		SPF
I - G	2x4	DRY	No.2		SPF

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+P	MT20	3.0	4.0		
C	TMWW-1	MT20	4.0	4.0		
D	TTW-P	MT20	4.0	4.0	2.25	2.00
E	TMWW-1	MT20	4.0	4.0		
F	TMV+P	MT20	3.0	4.0		
G	BMWW-1	MT20	4.0	4.0		
H	BMWW-1	MT20	4.0	9.0		
I	BMWW-1	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
I	1001	0	1001	0
G	875	0	875	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
I	708	476 0	0 0	0 0	229 0	0 0
G	619	406 0	0 0	0 0	213 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED HORZ. LOAD (LBS)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED HORZ. LOAD (LBS)
FR-TO					FR-TO			
A-B	0 35	-81.8	-81.8 0.12 (1)	10.00	C-H	-228 0	0 12 (1)	0 10 (1)
B-C	0 24	-81.8	-81.8 0.24 (1)	10.00	H-D	0 449	0 10 (1)	0 09 (1)
C-D	-691 0	-81.8	-81.8 0.19 (1)	6.25	H-E	-168 0	0 50 (1)	0 44 (1)
D-E	-689 0	-81.8	-81.8 0.17 (1)	6.25	I-C	-968 0	0 50 (1)	0 44 (1)
E-F	0 24	-81.8	-81.8 0.22 (1)	10.00	E-G	-971 0	0 44 (1)	0 44 (1)
F-G	-269 0	0 0	0 0.03 (1)	7.81				
G-F	-125 0	0 0	0 0.01 (1)	7.81				
I-H	0 722	-18.5	-18.5 0.39 (4)	10.00				
H-G	0 677	-18.5	-18.5 0.39 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH LL = 25.8 PSF
DL = 6.0 PSF
BOT CH LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.53")
CALCULATED VERT. DEFL.(LL) = L/989 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.53")
CALCULATED VERT. DEFL.(TL) = L/989 (0.11")

CSI: TC=0.24/1.00 (B-C:1), BC=0.39/1.00 (H-I:4), WB=0.50/1.00 (C-I:1), SSI=0.15/1.00 (C-D:1)

DDL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1686

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (E) (INPUT = 0.90)
JSI METAL= 0.35 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007613


JOB NAME 408223	TRUSS NAME T11B	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 3.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:01 2020 Page 1

ID:DMCubINVR6TsIFoe31v6I_zns11-SxVsS1cVvDTdV3g25IMsNOthBxxWB7PWsSQ4izMEMI

Scale = 1:38.5

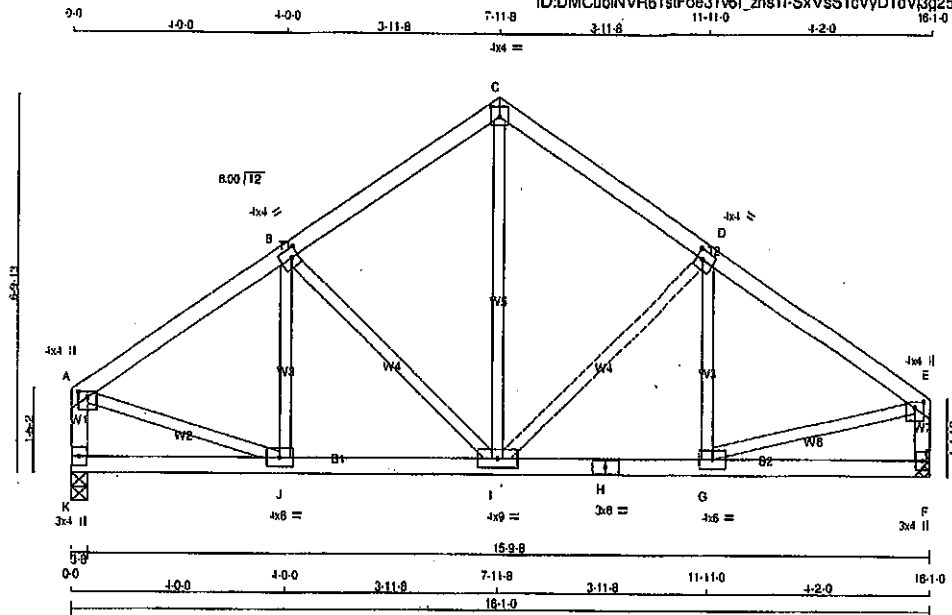

TOTAL WEIGHT = 2 X 69 = 137 lb
(M/F)

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
K - A	2x4	DRY	No.2	SPF
F - E	2x4	DRY	No.2	SPF
K - H	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25 2.00
B	TMWW-i	MT20	4.0	4.0	2.00 1.50
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TMWW-i	MT20	4.0	4.0	2.00 1.50
E	TMVW+p	MT20	4.0	4.0	1.25 2.00
F	BMV1+p	MT20	3.0	4.0	
G	BMWW-i	MT20	4.0	8.0	
H	BS-i	MT20	3.0	8.0	
I	BMWW-i	MT20	4.0	9.0	
J	BMWW-i	MT20	4.0	6.0	
K	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG
K	VERT	HORZ	UPLIFT	IN-SX
F	887 0	887 0	0 0	3-8 3-8
			MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3-8.

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED SNOW LIVE PERM. LIVE WIND DEAD SOIL
K	627 411 0 0 0 0 0 0 216 0 0 0
F	627 411 0 0 0 0 0 0 216 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD	LC1 MAX	MEMB.	FORCE
(LBS)	(PLF)	CS1 (LC)	UNBRAC	(LBS)	MAX
FR-TO	FROM TO	CS1 (LC)	LENGTH	FR-TO	CS1 (LC)
A-B	-888 0	-91.8 -91.8 0.19 (1)	6.25	J-B	-142 18 0.04 (1)
B-C	-687 0	-91.8 -91.8 0.18 (1)	6.25	B-I	-263 0 0.13 (1)
C-D	-688 0	-91.8 -91.8 0.19 (1)	6.25	I-C	0 461 0.10 (1)
D-E	-891 0	-91.8 -91.8 0.20 (1)	6.25	I-D	-292 0 0.15 (1)
K-A	-855 0	0.0 0.0 0.09 (1)	7.81	G-D	-117 28 0.03 (1)
F-E	-853 0	0.0 0.0 0.09 (1)	7.81	A-J	0 772 0.17 (1)
				G-E	0 787 0.18 (1)
K-J	0 0	-18.5 -18.5 0.07 (4)	10.00		
J-I	0 740	-18.5 -18.5 0.15 (1)	10.00		
I-H	0 781	-18.5 -18.5 0.15 (1)	10.00		
H-G	0 781	-18.5 -18.5 0.15 (1)	10.00		
G-F	0 0	-18.5 -18.5 0.07 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD! EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.54")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CS1: TO=0.20/1.00 (D-E:1), BC=0.15/1.00 (G-I:1),
WB=0.18/1.00 (E-G:1), SS=0.15/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MAX	MIN	MAX	MIN
MT20	618	354	1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (E) (INPUT = 0.90)
JSI METAL = 0.25 (H) (INPUT = 1.00)




Structural component only
DWG# T-2007631

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T11S	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:00:13 2020 Page 1

ID:DMCubINVR6TslFoe31v6l_zns11-YVCj26HKS3BnFRQz081gj7reK5PdcqyG49siazMF1W

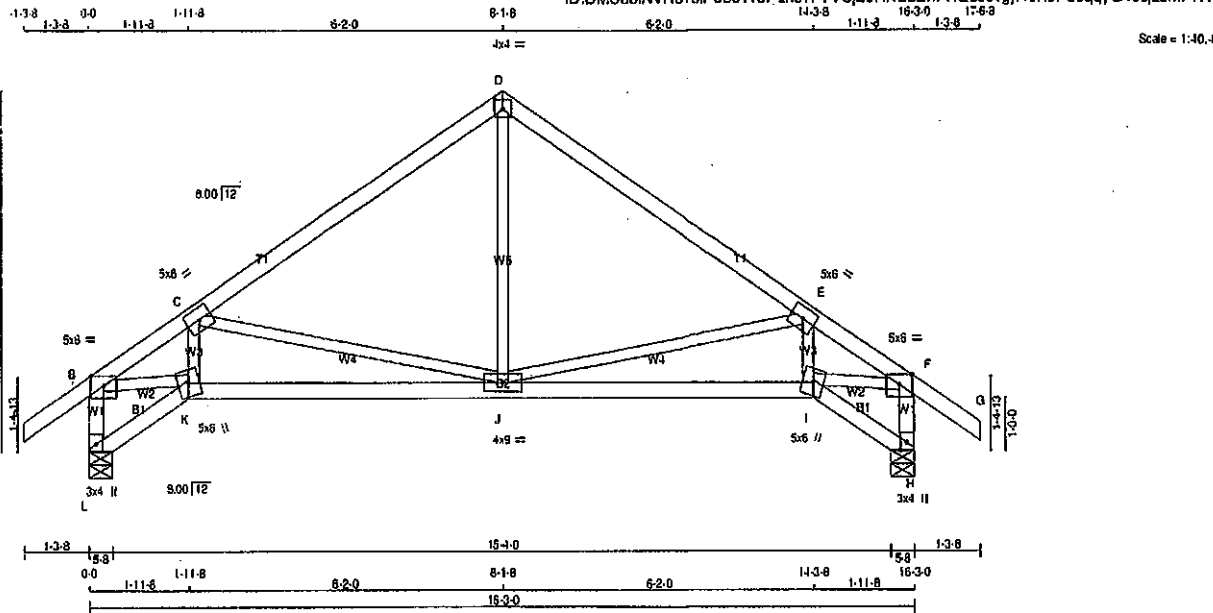

TOTAL WEIGHT = 2 X 67 = 134 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
L - B	2x4	DRY	No.2	SPF	
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
L - K	2x4	DRY	No.2	SPF	
K - I	2x4	DRY	No.2	SPF	
I - H	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	Edge		
C	TMVW-t	MT20	5.0	6.0			
D	TTW-p	MT20	4.0	4.0	2.25	2.00	
E	TMVW-t	MT20	5.0	6.0			
F	TMVW-p	MT20	5.0	6.0	Edge		
H	BMVW-p	MT20	3.0	4.0	Edge		
I	BMVW-m	MT20	5.0	6.0			
J	BMVW-t	MT20	4.0	9.0			
K	BMVW-m	MT20	5.0	6.0			
L	BMVW-p	MT20	3.0	4.0	Edge		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
		GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
L	1022	0	1022	0	5-8
H	1022	0	1022	0	5-8

UNFACTORED REACTIONS		1ST CASE	MAX. MIN. COMPONENT REACTIONS	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW						
L	720	486	0	0	0	0	234	0
H	720	486	0	0	0	0	234	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.97 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO	LENGTH FR-TO
L-B	-1004	0	7.80
A-B	0	35	10.00
B-C	-1508	0	4.97
C-D	-941	0	6.08
D-E	-941	0	6.07
E-F	-1510	0	4.97
F-G	0	35	10.00
H-F	-1004	0	7.80
L-K	0	0	10.00
K-J	0	1319	10.00
J-I	0	1320	10.00
I-H	0	0	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.54")
CALCULATED VERT. DEFL.(TL) = L/999 (0.08")

CSI: TG=0.42/1.00 (D-E:1), BC=0.33/1.00 (J-I:1), WB=0.47/1.00 (E-J:1), SS=0.21/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (I) (INPUT = 0.90)
JSI METAL= 0.47 (K) (INPUT = 1.00)



Structural component only
DWG# T-2007614


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T12S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTak Industries, Inc. Tue Apr 28 09:00:14 2020 Page 1

ID:DMCubINVR6TslF0e31v6l zns1l-0hm5FSlyDNJdta79MsYvGLQuJVqYLOs6VkvQG0zMFIV

Scale = 1:27.5

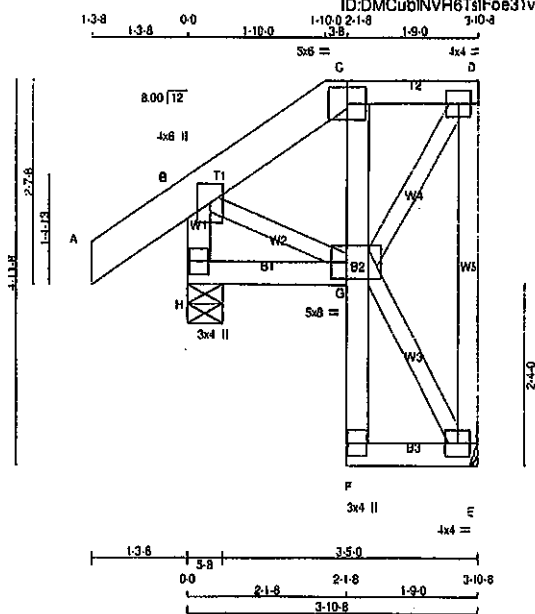

LUMBER				DESCR	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER		
A - C	2x6	DRY	No.2	SPF	
C - D	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	
H - B	2x4	DRY	No.2	SPF	
H - G	2x4	DRY	No.2	SPF	
F - C	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	8.0		
C	TTV-m	MT20	5.0	8.0		
D	TMVW-1	MT20	4.0	4.0		
E	BMVW-1	MT20	4.0	4.0		
F	BMV+p	MT20	3.0	4.0		
G	BVMWVW-1	MT20	5.0	8.0	2.50	2.50
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORIZ	DOWN	HORIZ
E	214	0	214	0
H	344	0	344	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
E	151	89	0	0	0	52	0	0
H	241	172	0	0	0	69	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)
FR-TO		FROM TO		FR-TO		FROM TO	
A-B	0 36	-91.8 -91.8	0.07 (5)	G-D	0 139	0.03 (1)	
B-C	-105 0	-91.8 -91.8	0.03 (1)	B-G	0 98	0.02 (1)	
C-D	-79 0	-91.8 -91.8	0.05 (1)	G-E	-3 0	0.09 (1)	
E-D	-196 0	0.0 0.0	0.06 (1)				
H-B	-323 0	0.0 0.0	0.03 (1)				
H-G	0 0	-18.5 -18.5	0.03 (4)				
F-G	0 17	0.0 0.0	0.01 (1)				
G-C	-119 0	0.0 0.0	0.01 (1)				
F-E	0 2	-18.5 -18.5	0.01 (4)				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.08:1.00 (D-E:1), BC=0.03:1.00 (G-H:4), WB=0.03:1.00 (D-G:1), SS=0.07:1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PS)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.18 (B) INPUT = 0.90
JSI METAL = 0.11 (B) INPUT = 1.00



Structural component only
DWG# T-2007615


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRAWNG.
408223	T20	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 M/Tek Industries, Inc. Tue Apr 28 10:04:02 2020 Page 1

ID:DMCubINVR6TstFoe31v6l zns1l-x73EgNd7XbU8sescDbPaw0PaBNFZ7YIIB c8zMEMh

1-3-8 0-0 4-10-0 5-2-12 8-0-6 11-3-2 8-3-14 17-7-0 8-3-14 23-10-14 6-5-2 30-4-0 4-10-0 35-2-0 1-3-8
Scale = 1:57.6

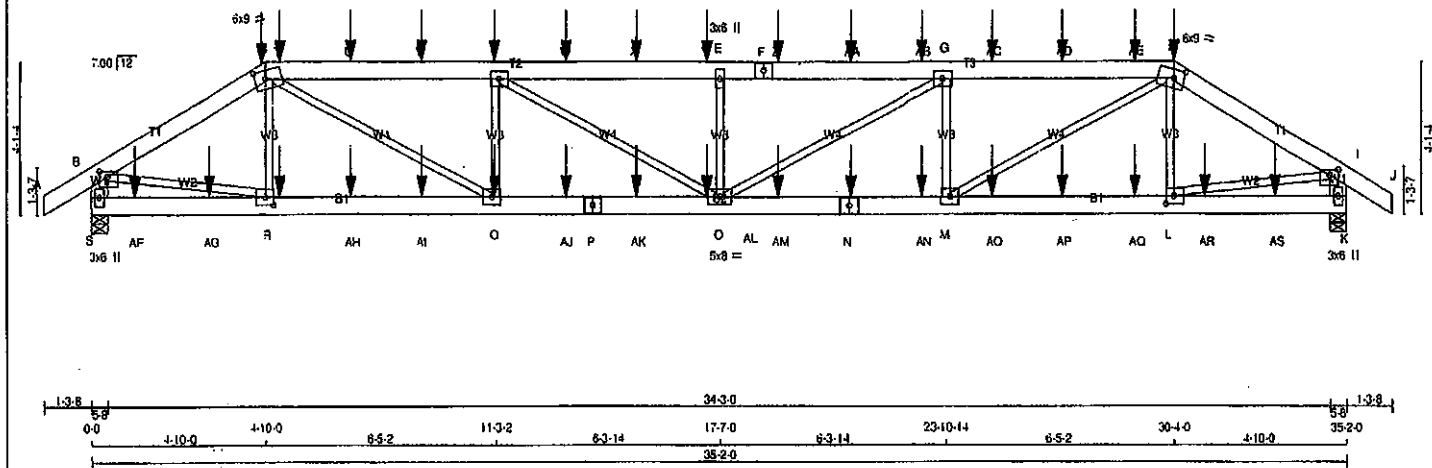

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x6	DRY	No.2
C - F	2x6	DRY	No.2
F - H	2x6	DRY	No.2
H - J	2x6	DRY	No.2
S - B	2x6	DRY	No.2
K - I	2x6	DRY	No.2
S - P	2x6	DRY	No.2
P - N	2x6	DRY	No.2
N - K	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122'X3') SPIRAL NAILS		
A - C	2	12
C - F	2	12
F - H	2	12
H - J	2	12
S - B	2	12
K - I	2	12
BOTTOM CHORDS : (0.122'X3') SPIRAL NAILS		
S - P	2	12
P - N	2	12
N - K	2	12
WEBS : (0.122'X3') SPIRAL NAILS		
2x3	1	6

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLYS FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	DOWN	UPLIFT	IN-SX
S	3423	0	5-8
K	3365	0	5-8

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS						
JT COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
S	2418	1600	0	0	0	0	818
K	2378	1573	0	0	0	0	804

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.03 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. MEMB. FORCE (LBS)
FR-A	0	33	
A-B	-4681	0	
B-C	-7102	0	
C-T	-7102	0	
T-U	-7102	0	
U-V	-7102	0	
V-O	-7102	0	
O-W	-8010	0	
W-X	-8010	0	
X-Y	-8010	0	
Y-E	-8010	0	
E-F	-8010	0	
F-Z	-8010	0	
Z-AA	-8010	0	
AA-AB	-8010	0	
AB-G	-8010	0	
G-AC	-7070	0	
AC-AD	-7070	0	
AD-AE	-7070	0	
AE-H	-7070	0	
H-I	-4806	0	
I-J	0	33	
S-B	-3387	0	
K-I	-3318	0	

WEBS

MEMB.	MAX. FACTORED FORCE (LBS)	MAX. MEMB. FORCE (LBS)
R-C	-431	9
C-Q	0	3534
Q-D	-1555	0
D-O	0	1048
O-E	-884	0
E-G	0	1085
G-H	-1573	0
H-M	0	3572
M-L	-421	10
L-I	0	4022

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL	= 25.8 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, NBCC 2015
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.20")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.37")

CSI: TC=0.33 (1.00 (E-G)), BC=0.52 (1.00 (O-Q)), WB=0.51 (1.00 (B-R)), SSI=0.18 (1.00 (G-H))

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1867 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (Q) INPUT = 0.90
JSI METAL = 0.68 (P) INPUT = 1.00

CONTINUED ON PAGE 2

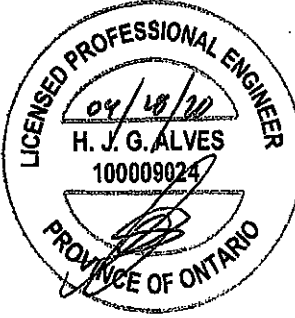

Structural component only
DWG# T-2007632 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T20	1	2	TRUSS DESC.		

Tenarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:02 2020 Page 2

ID:DMCubINVR6TslFoa31v6I zns1l-x73EqNd70XbU6sesc0DbPaw0PaBNFZ7YIB c8zMEMh

PLATES (inches in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	2.75
C	TTWW-m	MT20	6.0	9.0	2.75	3.50
D	TMWW-i	MT20	5.0	6.0		
E	TMWW-w	MT20	3.0	6.0		
F	TS-i	MT20	5.0	6.0		
G	TMWW-i	MT20	5.0	6.0		
H	TTWW-m	MT20	6.0	9.0	2.75	3.50
I	TMWW-p	MT20	5.0	6.0	1.75	2.75
K	BMV1-p	MT20	3.0	6.0		
L	BMWW-i	MT20	5.0	6.0	2.50	2.75
M	BMWW-i	MT20	5.0	6.0		
N	BS-i	MT20	5.0	6.0		
O	BMWW-i	MT20	5.0	6.0		
P	BS-i	MT20	5.0	6.0		
Q	BMWW-i	MT20	5.0	6.0		
R	BMWW-i	MT20	5.0	6.0	2.50	2.75
S	BMV1-p	MT20	3.0	6.0		

LOADING

TOTAL LOAD CASES: (4)

CHORDS

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX.	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX.
FR-TO		FROM	TO	LENGTH	FR-TO		FROM	TO	LENGTH
LAR	0 0	-18.5	-18.5	0.06 (4)	10.00				
AR-AS	0 0	-18.5	-18.5	0.06 (4)	10.00				
AS-K	0 0	-18.5	-18.5	0.06 (4)	10.00				

WEBS

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-10-0	-80	-67	---	FRONT	VERT.	DEAD	---	C1
C	4-10-0	-311	-311	---	FRONT	VERT.	SNOW	---	C1
D	11-2-12	-110	-110	---	FRONT	VERT.	TOTAL	---	C1
H	30-4-0	-80	-67	---	FRONT	VERT.	DEAD	---	C1
H	30-4-0	-311	-311	---	FRONT	VERT.	SNOW	---	C1
N	21-2-12	-26	-26	---	FRONT	VERT.	TOTAL	---	C1
Q	11-2-12	-26	-26	---	FRONT	VERT.	TOTAL	---	C1
R	5-2-12	-26	-26	---	FRONT	VERT.	TOTAL	---	C1
T	5-2-12	-138	-138	---	FRONT	VERT.	TOTAL	---	C1
U	7-2-12	-110	-110	---	FRONT	VERT.	TOTAL	---	C1
V	9-2-12	-110	-110	---	FRONT	VERT.	TOTAL	---	C1
W	13-2-12	-110	-110	---	FRONT	VERT.	TOTAL	---	C1
X	15-2-12	-110	-110	---	FRONT	VERT.	TOTAL	---	C1
Y	17-2-12	-110	-110	---	FRONT	VERT.	TOTAL	---	C1
Z	18-2-12	-110	-110	---	FRONT	VERT.	TOTAL	---	C1
AA	21-2-12	-110	-110	---	FRONT	VERT.	TOTAL	---	C1
AB	23-2-12	-110	-110	---	FRONT	VERT.	TOTAL	---	C1
AC	25-2-12	-110	-110	---	FRONT	VERT.	TOTAL	---	C1
AD	27-2-12	-110	-110	---	FRONT	VERT.	TOTAL	---	C1
AE	29-2-12	-110	-110	---	FRONT	VERT.	TOTAL	---	C1
AF	1-2-12	-26	-26	---	FRONT	VERT.	TOTAL	---	C1
AG	3-2-12	-26	-26	---	FRONT	VERT.	TOTAL	---	C1
AH	7-2-12	-26	-26	---	FRONT	VERT.	TOTAL	---	C1
AI	9-2-12	-26	-26	---	FRONT	VERT.	TOTAL	---	C1
AJ	13-2-12	-26	-26	---	FRONT	VERT.	TOTAL	---	C1
AK	15-2-12	-26	-26	---	FRONT	VERT.	TOTAL	---	C1
AL	17-2-12	-26	-26	---	FRONT	VERT.	TOTAL	---	C1
AM	19-2-12	-26	-26	---	FRONT	VERT.	TOTAL	---	C1
AN	23-2-12	-26	-26	---	FRONT	VERT.	TOTAL	---	C1
AO	25-2-12	-26	-26	---	FRONT	VERT.	TOTAL	---	C1
AP	27-2-12	-26	-26	---	FRONT	VERT.	TOTAL	---	C1
AQ	29-2-12	-26	-26	---	FRONT	VERT.	TOTAL	---	C1
AR	31-2-12	-26	-26	---	FRONT	VERT.	TOTAL	---	C1
AS	33-2-12	-26	-26	---	FRONT	VERT.	TOTAL	---	C1

CONNECTION REQUIREMENTS


1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007632

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T21	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:03 2020 Page 1
 ID:DMCubINVR6TstFoe31v6I zns11-PKdclleUqLk0D3AWQxoT6J Wk xSi yxX9bzMEMg
 Scale = 1:57.6

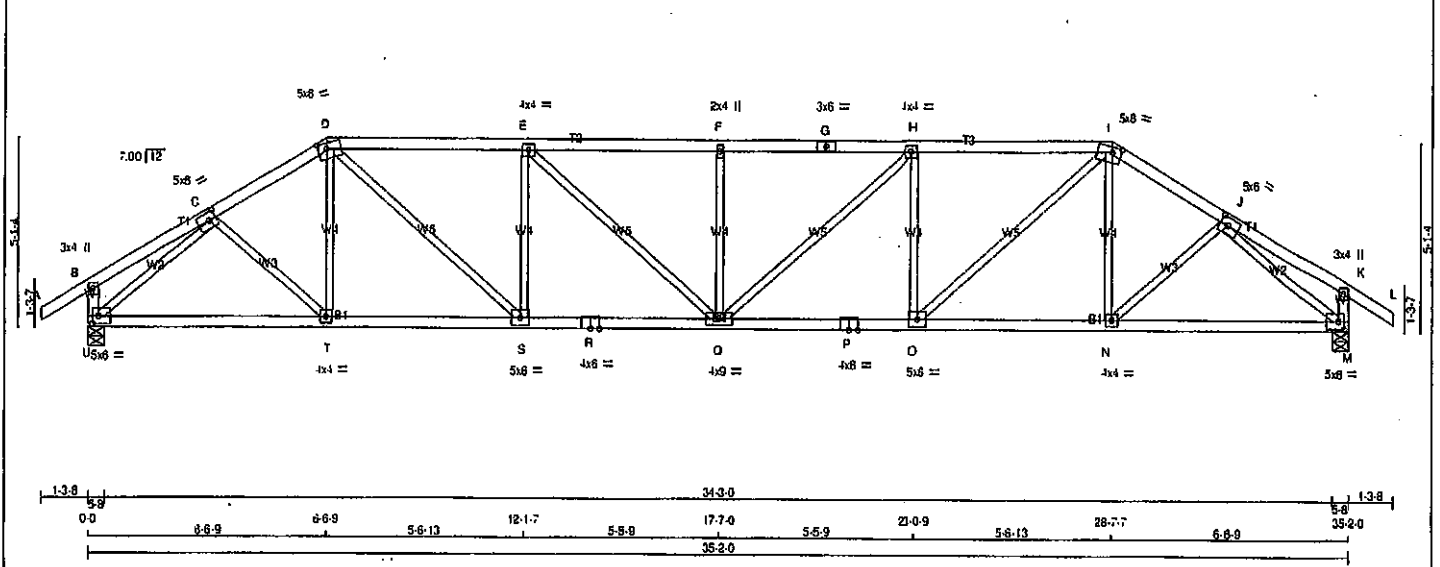


LUMBER
 N. L. G. A. RULES
 CHORDS SIZE LUMBER DESCR. TOTAL WEIGHT = 142 lb

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - K	2x4	DRY	No.2
K - P	2x4	DRY	No.2
P - M	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table in inches)	W	LEN	Y	X
JT TYPE				
B TMVp	MT20	3.0	4.0	
C TMWW-I	MT20	5.0	6.0	2.50 2.50
D TTWW-m	MT20	5.0	8.0	1.75 3.00
E TMWW-I	MT20	4.0	4.0	
F TMWW-w	MT20	2.0	4.0	
G TS-I	MT20	3.0	6.0	
H TMWW-I	MT20	4.0	4.0	
I TTWW-m	MT20	5.0	8.0	1.75 3.00
J TMWW-I	MT20	5.0	6.0	2.50 2.50
K TMVp	MT20	3.0	4.0	
M BMWW-I	MT20	5.0	6.0	2.50 2.00
N BMWW-I	MT20	4.0	4.0	
O BMWW-I	MT20	5.0	6.0	
P BS-I	MT20	4.0	6.0	
Q BMWW-I	MT20	4.0	9.0	
R BS-I	MT20	4.0	6.0	
S BMWW-I	MT20	5.0	6.0	
T BMWW-I	MT20	3.0	4.0	
U BMWW-I	MT20	5.0	6.0	2.50 2.00

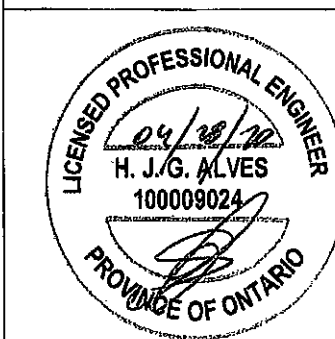

Structural component only
 DWG# T-2007633

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG
U	VERT	DOWN	IN-SX	IN-SX
M	2064 0	2064 0	5-8	5-8

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
U	1457 970 0	0:0 0 0 0 488 0 0 0
M	1457 970 0	0:0 0 0 0 488 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.12 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX	MAX	WEBS	MAX. FACTORED	MAX
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CS (ILC)	UNBRAC	MEMB.	FORCE (LBS)	CS (ILC)
FR-TO					FR-TO		
A-B	0 32	-91.8 -91.8 0.12 (1)	10.00	C-T	0 213	0.05 (1)	
B-C	0 13	-91.8 -91.8 0.12 (1)	10.00	T-D	-8 69	0.02 (4)	
C-D	-2627 0	-91.8 -91.8 0.20 (1)	4.18	D-S	0 1447	0.33 (1)	
D-E	-3264 0	-91.8 -91.8 0.66 (1)	3.30	S-E	-853 0	0.33 (1)	
E-F	-3585 0	-91.8 -91.8 0.70 (1)	3.12	E-Q	0 428	0.10 (1)	
F-G	-3585 0	-91.8 -91.8 0.70 (1)	3.12	Q-F	-482 0	0.18 (1)	
G-H	-3585 0	-91.8 -91.8 0.70 (1)	3.12	Q-H	0 428	0.10 (1)	
H-I	-3264 0	-91.8 -91.8 0.66 (1)	3.30	O-H	-853 0	0.33 (1)	
I-J	-2527 0	-91.8 -91.8 0.20 (1)	4.18	O-I	0 1447	0.33 (1)	
J-K	0 13	-91.8 -91.8 0.12 (1)	10.00	N-I	-8 69	0.02 (4)	
K-L	0 32	-91.8 -91.8 0.12 (1)	10.00	N-J	0 213	0.05 (1)	
U-B	-249 0	0 0 0.03 (1)	7.81	U-C	-2871 0	0.82 (1)	
M-K	-249 0	0 0 0.03 (1)	7.81	J-M	-2871 0	0.82 (1)	
U-T	0 2005	-18.5 -18.5 0.42 (1)	10.00				
T-S	0 2167	-18.5 -18.5 0.44 (1)	10.00				
S-R	0 3284	-18.5 -18.5 0.58 (1)	10.00				
R-Q	0 3284	-18.5 -18.5 0.58 (1)	10.00				
Q-P	0 3284	-18.5 -18.5 0.58 (1)	10.00				
P-O	0 3284	-18.5 -18.5 0.58 (1)	10.00				
O-N	0 2167	-18.5 -18.5 0.44 (1)	10.00				
N-M	0 2005	-18.5 -18.5 0.42 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

156 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CSK TC=0.70/1.00 (E-F:1), BC=0.58/1.00 (Q-S:1), WB=0.82/1.00 (J-K:1), SSI=0.24/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (M) (INPUT = 0.90)
 JSI METAL = 0.74 (R) (INPUT = 1.00)


JOB NAME 408223	TRUSS NAME T22	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.310 3 Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:04:04 2020 Page 1

ID:DMCubINVR6TstFoe31v8l zns11-WB743eNF8rCMAoFDG3U?0GFOdITrCcg4h1zMEMI

1-3-8 0-0 4-2-13 4-2-13 4-0-5 8-3-2 14-6-2 6-1-12 20-7-14 6-3-0 28-10-14 4-0-5 30-11-3 4-2-13 35-2-0 1-3-8
Scale = 1:57.6

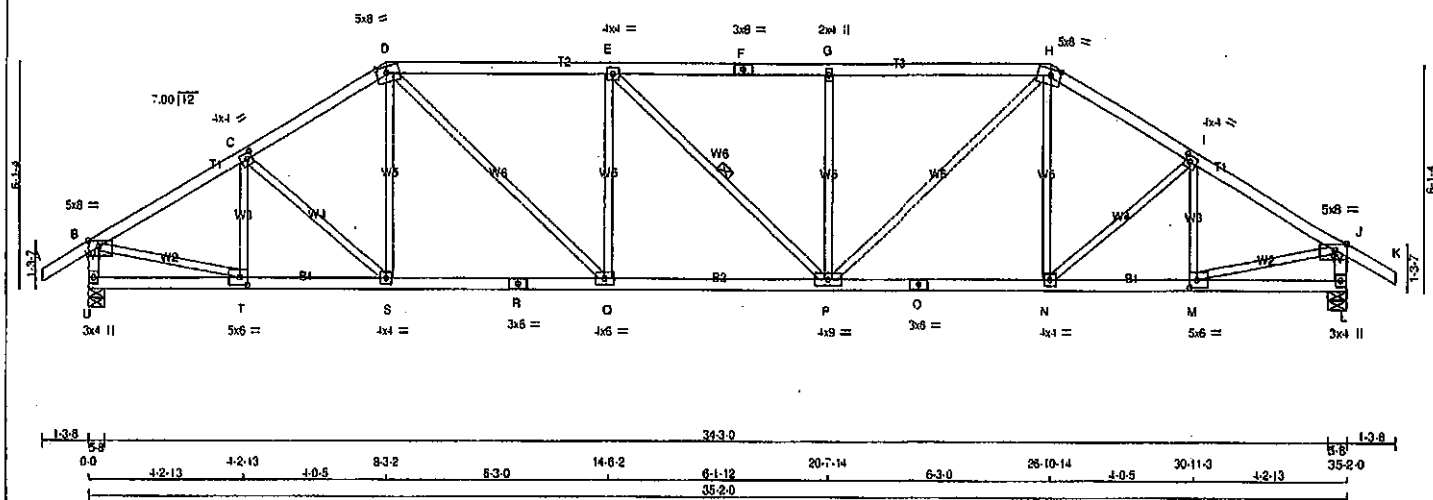

TOTAL WEIGHT = 146 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY No.2	SPF
E - F	2x4	DRY No.2	SPF
F - H	2x4	DRY No.2	SPF
H - K	2x4	DRY No.2	SPF
U - B	2x4	DRY No.2	SPF
L - J	2x4	DRY No.2	SPF
U - R	2x4	DRY No.2	SPF
R - O	2x4	DRY No.2	SPF
O - L	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMWW-p	MT20	5.0	8.0	Edge 3.50
C	TMWW-i	MT20	4.0	4.0	2.00 1.75
D	TTWW-m	MT20	5.0	8.0	2.00 3.50
E	TMWW-i	MT20	4.0	4.0	
F	TS-i	MT20	3.0	6.0	
G	TMWW-w	MT20	2.0	4.0	
H	TTWW-m	MT20	5.0	8.0	2.00 3.50
I	TMWW-i	MT20	4.0	4.0	2.00 1.75
J	TMWW-p	MT20	5.0	8.0	Edge 3.50
L	BMV-i-p	MT20	3.0	4.0	
M	BMWW-i	MT20	5.0	8.0	2.50 2.50
N	BMWW-i	MT20	4.0	4.0	
O	BS-i	MT20	3.0	6.0	
P	BMWW-i	MT20	4.0	4.0	
Q	BMWW-i	MT20	4.0	4.0	
R	BS-i	MT20	3.0	6.0	
S	BMWW-i	MT20	4.0	4.0	
T	BMWW-i	MT20	5.0	8.0	2.50 2.50
U	BMV-i-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
U	2084	0	2084	0	0	5-8	5-8	5-8	5-8
L	2084	0	2084	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	COMBINED	SNOW
U	1457	970	0	0	0	0	0	488	0
L	1457	970	0	0	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS U, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.37 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CS1 (LC)	MAX. UNBRACED LENGTH	FR-TO	MEMB.	FORCE (LBS)	MAX. UNBRACED LENGTH	FR-TO
A-B	0 32	-91.8	-91.8 0.12 (1)	10.00	T-C	-426	0	0.10 (1)	
B-C	-2468	0	-91.8	-91.8 0.35 (1)	4.07	C-S	-39	0	0.02 (1)
C-D	-2478	0	-91.8	-91.8 0.34 (1)	4.06	S-D	0 131	0.04 (4)	
D-E	-2910	0	-91.8	-91.8 0.75 (1)	3.37	D-Q	0 1076	0.24 (1)	
E-F	-2909	0	-91.8	-91.8 0.74 (1)	3.38	Q-E	-817	0	0.36 (1)
F-G	-2909	0	-91.8	-91.8 0.74 (1)	3.38	E-P	-2	0	0.00 (1)
G-H	-2909	0	-91.8	-91.8 0.75 (1)	3.38	P-G	-617	0	0.36 (1)
H-I	-2478	0	-91.8	-91.8 0.34 (1)	4.06	P-H	0 1073	0.24 (1)	
I-J	-2468	0	-91.8	-91.8 0.35 (1)	4.07	H-N	0 132	0.04 (4)	
J-K	0 32	-91.8	-91.8 0.12 (1)	10.00	N-I	-39	0	0.02 (1)	
U-B	-2025	0	0.0	0.0 0.21 (1)	5.94	M-I	-426	0	0.10 (1)
L-J	-2025	0	0.0	0.0 0.21 (1)	5.94	B-T	0 2205	0.50 (1)	
U-T	0 0	-18.5	-18.5 0.07 (4)	10.00	M-J	0 2205	0.50 (1)		
T-S	0 2149	-18.5	-18.5 0.41 (1)	10.00					
S-R	0 2122	-18.5	-18.5 0.41 (1)	10.00					
R-Q	0 2122	-18.5	-18.5 0.41 (1)	10.00					
Q-P	0 2910	-18.5	-18.5 0.54 (1)	10.00					
P-O	0 2122	-18.5	-18.5 0.41 (1)	10.00					
O-N	0 2122	-18.5	-18.5 0.41 (1)	10.00					
N-M	0 2149	-18.5	-18.5 0.41 (1)	10.00					
M-L	0 0	-18.5	-18.5 0.07 (4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 080-09, CSA 080-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.16")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.30")

CSI: TC=0.75 (1.00) (D-E:1), SC=0.54 (1.00) (P-Q:1), WB=0.50 (1.00) (B-T:1), SS=0.27 (1.00) (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.89 (1) (INPUT = 0.90)
JSI METAL = 0.70 (1) (INPUT = 1.00)



Structural component only
DWG# T-2007634

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T23	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:04:08 2020 Page 1		ID:DMCubINVR6TstFoe31v6l zns11-pvJIVkgeml5wbUyerelXZQ5aqCaVBJG8gw9BvzMEMd	
-1-3-8 0-0		5-1-2 5-1-2 4-10-10 3-11-11 7-7-5 17-7-0 7-7-5 4-10-10 30-0-14 35-2-0 36-6-8		Scale = 1:57.6	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:04:08 2020 Page 1
ID:DMCubINVR6TstFoe31v6l zns11-pvJIVkgeml5wbUyerelXZQ5aqCaVBJG8gw9BvzMEMd
Scale = 1:57.6

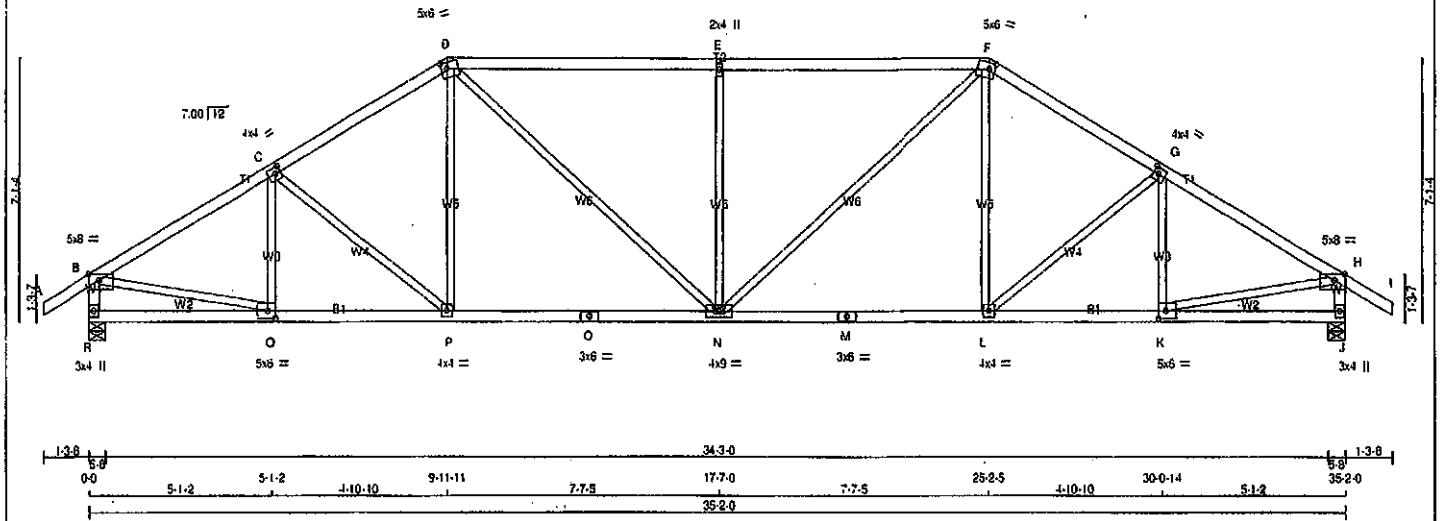

LUMBER	N L G A RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - I	2x4	DRY	No.2	SPF	
R - B	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
R - O	2x4	DRY	No.2	SPF	
O - M	2x4	DRY	No.2	SPF	
M - J	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	3.50
C	TMVW-l	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	8.0	2.00	2.00
E	TMVW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	8.0	2.00	2.00
G	TMVW-l	MT20	4.0	4.0	2.00	1.75
H	TMVW-p	MT20	5.0	8.0	Edge	3.50
J	BMVl-p	MT20	3.0	4.0		
K	BMVW-l	MT20	5.0	8.0	2.50	2.50
L	BMVW-l	MT20	4.0	4.0		
M	BS-l	MT20	3.0	6.0		
N	BMVW-w-l	MT20	4.0	9.0		
O	BS-l	MT20	3.0	6.0		
P	BMVW-l	MT20	4.0	4.0		
Q	BMVW-l	MT20	5.0	6.0	2.50	2.50
R	BMVl-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER:

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
R	2084	0	2064	0
J	2084	0	2064	0

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	1457	970 0	0 0	0 0	0 0	488 0	0 0
J	1457	970 0	0 0	0 0	0 0	488 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.16 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS					
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX CS1 (LBS)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LBS)		
FR-TO		FROM	TO			FR-TO				
A-B	0	32	-91.8	-91.8	0.12 (1)	10.00	C-Q	-335	0	0.09 (1)
B-C	-2537	0	-91.8	-91.8	0.39 (1)	4.00	C-P	-216	0	0.16 (1)
C-D	-2398	0	-91.8	-91.8	0.37 (1)	4.11	P-O	0	258	0.08 (4)
D-E	-2608	0	-91.8	-91.8	0.88 (1)	3.18	D-N	0	752	0.17 (1)
E-F	-2609	0	-91.8	-91.8	0.88 (1)	3.18	N-E	-860	0	0.75 (1)
F-G	-2398	0	-91.8	-91.8	0.37 (1)	4.11	N-F	0	752	0.17 (1)
G-H	-2537	0	-91.8	-91.8	0.39 (1)	4.00	L-F	0	258	0.08 (4)
H-I	0	32	-91.8	-91.8	0.12 (1)	10.00	L-G	-216	0	0.16 (1)
I-B	-2020	0	0.0	0.0	0.21 (1)	5.94	K-G	-335	0	0.09 (1)
J-H	-2020	0	0.0	0.0	0.21 (1)	5.94	B-Q	0	2253	0.51 (1)
							K-H	0	2253	0.51 (1)
R-Q	0	0	-18.5	-18.5	0.10 (4)	10.00				
O-P	0	2213	-18.5	-18.5	0.45 (1)	10.00				
P-O	0	2048	-18.5	-18.5	0.44 (1)	10.00				
Q-N	0	2048	-18.5	-18.5	0.44 (1)	10.00				
N-M	0	2048	-18.5	-18.5	0.44 (1)	10.00				
M-L	0	2048	-18.5	-18.5	0.44 (1)	10.00				
L-K	0	2213	-18.5	-18.5	0.45 (1)	10.00				
K-J	0	0	-18.5	-18.5	0.10 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TFC 2011, TFC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.13")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.27")

CSI: TC=0.88/1.00 (E-F:1), BC=0.45/1.00 (K-L:1),
WB=0.75/1.00 (E-N:1), SSI=0.34/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BAND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (K) (INPUT = 0.90)
JSI METAL = 0.72 (M) (INPUT = 1.00)



Structural component only
DWG# T-2007635


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T24	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 AMTek Industries, Inc. Tue Apr 28 10:04:07 2020 Page 1

ID:DMCubINVR6TsF0a31v6I_zns11-H5s7j4hGX3DnDwQpLpm8aapobw_wk8HuaVkiMzMEMC

1-3-8 0-0 5-11-6 5-11-6 5-8-14 11-8-5 5-10-11 17-7-0 5-10-11 23-5-11 5-8-14 29-2-10 5-11-6 1-3-8
Scale = 1:57.6

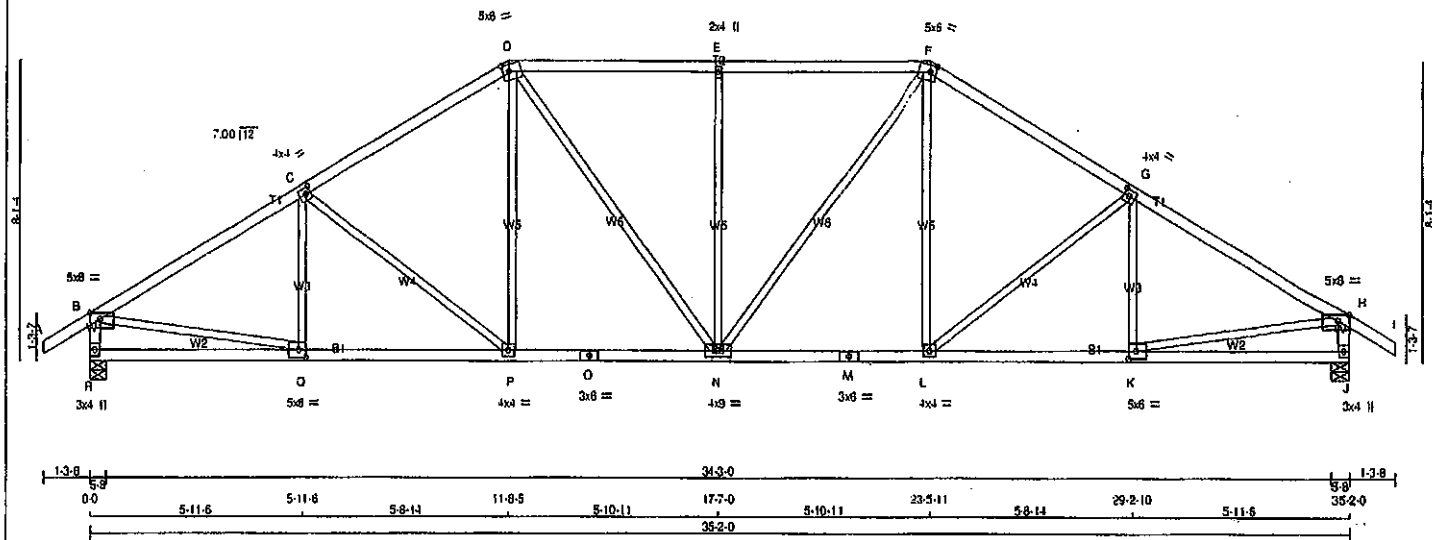

TOTAL WEIGHT = 151 lb

LUMBER	N. L. G. A. RULES	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
I - B	2x4	DRY	No.2	SPF
B - H	2x4	DRY	No.2	SPF
H - O	2x4	DRY	No.2	SPF
O - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	8.0	Edge	3.50
C TMVW-1	MT20	4.0	4.0	2.00	1.75
D TTWW-m	MT20	5.0	6.0	2.25	2.00
E TMVW-w	MT20	2.0	4.0		
F TTWW-m	MT20	5.0	6.0	2.25	2.00
G TMVW-1	MT20	4.0	4.0	2.00	1.75
H TMVW-p	MT20	5.0	8.0	Edge	3.50
J BMV1-p	MT20	3.0	4.0		
K BMVW-1	MT20	5.0	6.0	2.50	2.50
L BMVW-1	MT20	4.0	4.0		
M BS-1	MT20	3.0	6.0		
N BMVW-1	MT20	4.0	9.0		
O BS-1	MT20	3.0	6.0		
P BMVW-1	MT20	4.0	4.0		
Q BMVW-1	MT20	5.0	6.0	2.50	2.50
R BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG
R	2064	0	0	2064	0	0	0	5-8	5-8
J	2064	0	0	2064	0	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS								
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
R	1457	970	0	0	0	0	0	488	0
J	1457	970	0	0	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.81 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 32	-91.8 -91.8	0.12 (1)	10.00	Q-C	-252 12	0.08 (1)
B-C	-2575 0	-91.8 -91.8	0.54 (1)	3.81	C-P	-388 0	0.41 (1)
C-D	-2283 0	-91.8 -91.8	0.80 (1)	4.05	P-D	0 345	0.08 (1)
D-E	-2236 0	-91.8 -91.8	0.49 (1)	4.08	D-N	0 480	0.11 (1)
E-F	-2236 0	-91.8 -91.8	0.49 (1)	4.08	N-E	-662 0	0.84 (1)
F-G	-2283 0	-91.8 -91.8	0.50 (1)	4.05	N-F	0 480	0.11 (1)
G-H	-2575 0	-91.8 -91.8	0.54 (1)	3.81	L-F	0 345	0.08 (1)
H-I	0 32	-91.8 -91.8	0.12 (1)	10.00	L-G	-388 0	0.41 (1)
I-B	-2016 0	0.0 0.0	0.21 (1)	5.94	K-G	-252 12	0.08 (1)
J-H	-2016 0	0.0 0.0	0.21 (1)	5.94	B-Q	0 2281	0.51 (1)
					K-H	0 2281	0.51 (1)
R-O	0 0	-18.5 -18.5	0.14 (4)	10.00			
Q-P	0 2251	-18.5 -18.5	0.43 (1)	10.00			
P-O	0 1947	-18.5 -18.5	0.38 (1)	10.00			
O-N	0 1947	-18.5 -18.5	0.38 (1)	10.00			
N-M	0 1947	-18.5 -18.5	0.38 (1)	10.00			
M-L	0 1947	-18.5 -18.5	0.38 (1)	10.00			
L-K	0 2251	-18.5 -18.5	0.43 (1)	10.00			
K-J	0 0	-18.5 -18.5	0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CSI: TC=0.54/1.00 (B-C:1), BC=0.43/1.00 (P-Q:1),
WB=0.84/1.00 (E-N:1), SS=0.26/1.00 (D-E:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (FSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 610 354 1687 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.86 (Q) (INPUT = 0.90)
JSI METAL= 0.61 (M) (INPUT = 1.00)




Structural component only
DWG# T-2007636

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408223	T25	4	1	GREEN PARK HOMES		

Taggart Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:08 2020 Page 1

ID:DMCubINVR6tstFoe31v6l zns1IHQVwQhuINMdm50y3K7erAxP7FIIGSR7D9lqozMEMb

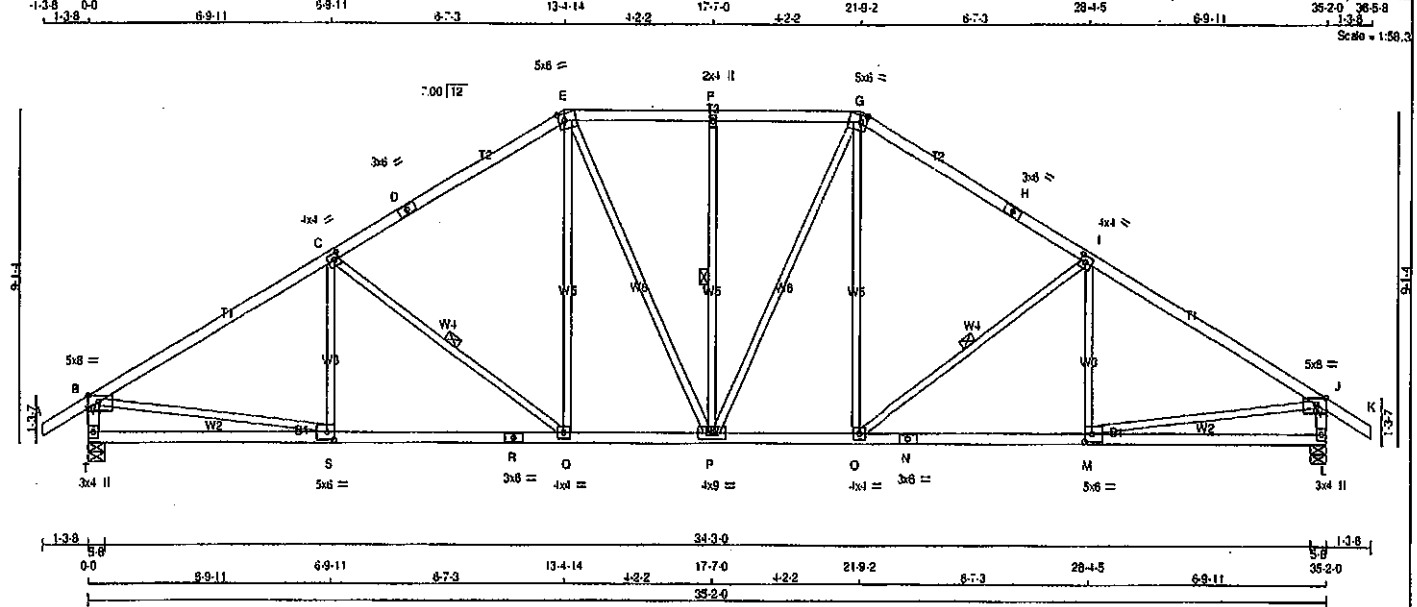

TOTAL WEIGHT = 4 X 158 = 632 lb (M/F)

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
T - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
T - R	2x4	DRY	No.2
R - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	8.0	Edge	3.50
C TMWW-t	MT20	4.0	4.0	2.00	1.75
D TS-t	MT20	3.0	6.0		
E TTWW-m	MT20	5.0	6.0	2.25	2.00
F TMW-w	MT20	2.0	4.0		
G TTWW-m	MT20	5.0	6.0	2.25	2.00
H TS-t	MT20	3.0	6.0		
I TMWW-t	MT20	4.0	4.0	2.00	1.75
J TMVW-p	MT20	5.0	8.0	Edge	3.50
L BMV1+p	MT20	3.0	4.0		
M BMWW-t	MT20	5.0	6.0	2.50	2.50
N BS-t	MT20	3.0	6.0		
O BMWW-t	MT20	4.0	4.0		
P BMWW-t	MT20	4.0	4.0		
Q BS-t	MT20	3.0	6.0		
S BMWW-t	MT20	5.0	6.0	2.50	2.50
T BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	HORZ	BRG	IN-SX	BRG	IN-SX
T	2084	0	0	2084	0	0	5-8	5-8	5-8
L	2084	0	0	2084	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST LCASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
T	1457	970	0	0	0
L	1457	970	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.54 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1:2 LENGTH OF C-Q, F-P, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING		TOTAL LOAD CASES: (4)	
CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. UNBRACED LENGTH FR-TO
FR-TO			
A-B	0 32	-91.8 -91.8 0.12 (1)	10.00
B-C	-2590 0	-91.8 -91.8 0.74 (1)	3.54
C-D	-2158 0	-91.8 -91.8 0.86 (1)	3.91
D-E	-2158 0	-91.8 -91.8 0.86 (1)	3.91
E-F	-1858 0	-91.8 -91.8 0.24 (1)	4.81
F-G	-1858 0	-91.8 -91.8 0.24 (1)	4.81
G-H	-2158 0	-91.8 -91.8 0.86 (1)	3.91
H-I	-2158 0	-91.8 -91.8 0.86 (1)	3.91
I-J	-2590 0	-91.8 -91.8 0.74 (1)	3.54
J-K	0 32	-91.8 -91.8 0.12 (1)	10.00
K-L	-2011 0	0.0 0.0 0.20 (1)	5.95
L-M	-2011 0	0.0 0.0 0.20 (1)	5.95
M-N	0 0	-18.5 -18.5 0.20 (4)	10.00
N-O	0 2269	-18.5 -18.5 0.46 (1)	10.00
O-P	0 2269	-18.5 -18.5 0.46 (1)	10.00
P-Q	0 1833	-18.5 -18.5 0.38 (1)	10.00
Q-R	0 1833	-18.5 -18.5 0.38 (1)	10.00
R-S	0 2269	-18.5 -18.5 0.46 (1)	10.00
S-T	0 2269	-18.5 -18.5 0.46 (1)	10.00
T-U	0 0	-18.5 -18.5 0.20 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN PLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.17")
CALCULATED VERT. DEFL.(LL)= L/999 (0.11")
ALLOWABLE DEFL.(TL)= L/360 (1.17")
CALCULATED VERT. DEFL.(TL)= L/999 (0.22")

CS: TC=0.74/1.00 (I-J:1), BC=0.48/1.00 (M-O:1), WB=0.52/1.00 (J-M:1), SS=0.28/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1997 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (S) (INPUT = 0.90)
JSI METAL= 0.89 (N) (INPUT = 1.00)




Structural component only
DWG# T-2007637

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T25A	3	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Tue Apr 28 10:04:09 2020 Page 1
ID:DMCubINVR6TsFoe31v6I zns11-DU u8miW3gUUSxgCWmsEB3j6iPbBOjwaMioMEzMEMa

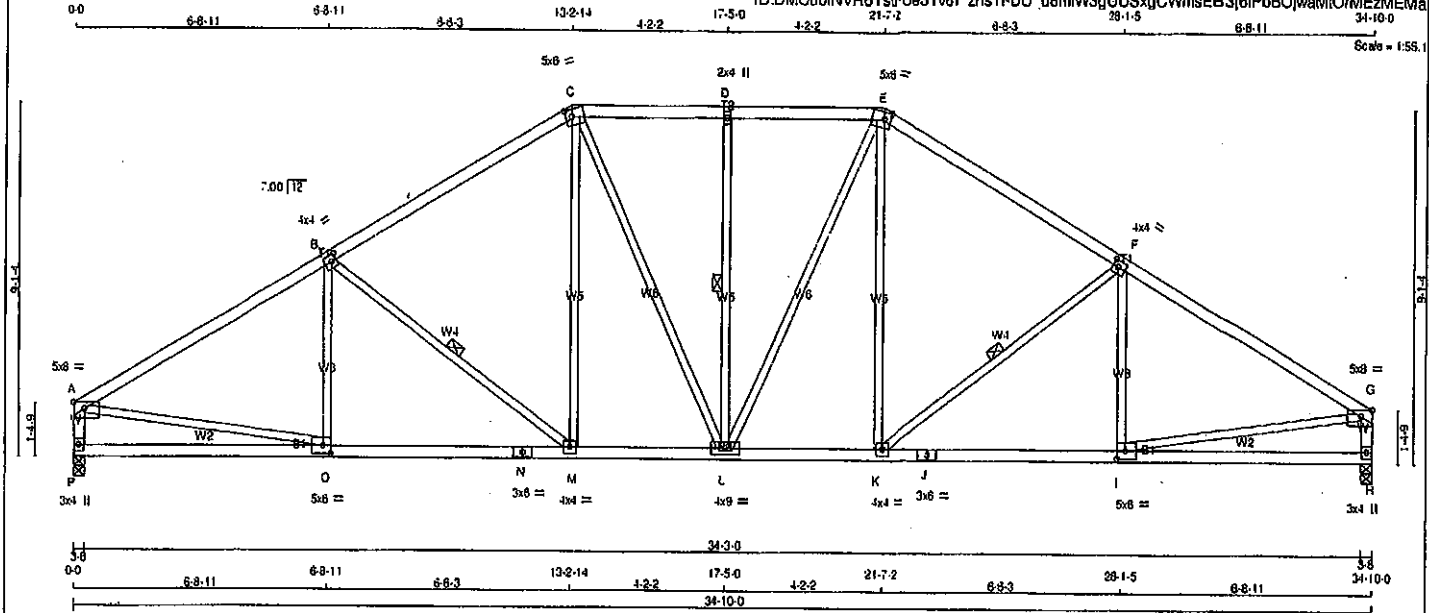

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
P - A	2x4	DRY	No.2
H - G	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A - C	TMVW-p	MT20	5.0	8.0	2.00 Edge
B - D	TMVW-t	MT20	4.0	4.0	2.00 1.75
C - E	TTWW-m	MT20	5.0	6.0	2.25 2.00
D - F	TMVW-w	MT20	2.0	4.0	
E - G	TTWW-m	MT20	5.0	8.0	2.25 2.00
F - H	TMVW-t	MT20	4.0	4.0	2.00 1.75
G - I	TMVW-p	MT20	5.0	8.0	Edge 3.50
H - J	BMV1-p	MT20	3.0	4.0	
I - K	BMVW-t	MT20	5.0	6.0	2.50 2.50
J - L	BS-t	MT20	3.0	6.0	
K - M	BMVW-t	MT20	4.0	4.0	
L - N	BMVW-w	MT20	4.0	4.0	
M - O	BS-t	MT20	3.0	6.0	
N - P	BMVW-t	MT20	5.0	6.0	2.50 2.50
O - Q	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED	MAXIMUM FACTORED	INPUT	REQ'D			
	GROSS REACTION	GROSS REACTION	BRG	BRG			
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
P	1920	0	1920	0	3-8	3-8	
H	1920	0	1920	0	0	3-8	3-8

UNFACTORED REACTIONS

1ST CASE							
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
P	1358	891	0	0	0	487	0
H	1358	891	0	0	0	487	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.64 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF 8-M D-L, F-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO				FR-TO			
A-B	-2510	0	-91.8 -91.8 0.71 (1)	3.84	O-B	-212	40
B-C	-2113	0	-91.8 -91.8 0.83 (1)	3.99	B-M	-510	0
C-D	-1919	0	-91.8 -91.8 0.24 (1)	4.84	M-C	0	412
D-E	-1919	0	-91.8 -91.8 0.24 (1)	4.84	C-L	0	287
E-F	-2113	0	-91.8 -91.8 0.83 (1)	3.99	L-D	-461	0
F-G	-2510	0	-91.8 -91.8 0.71 (1)	3.84	L-E	0	287
P-A	-1868	0	0.0 0.0 0.19 (1)	6.13	K-E	0	412
H-G	-1868	0	0.0 0.0 0.19 (1)	6.13	K-F	-510	0
					I-F	-212	40
P-O	0	0	-18.5 -18.5 0.20 (4)	10.00	A-O	0	2227
O-N	0	2199	-18.5 -18.5 0.45 (1)	10.00	I-G	0	2227
N-M	0	2199	-18.5 -18.5 0.45 (1)	10.00			
M-L	0	1787	-18.5 -18.5 0.35 (1)	10.00			
L-K	0	1787	-18.5 -18.5 0.35 (1)	10.00			
K-J	0	2199	-18.5 -18.5 0.45 (1)	10.00			
J-I	0	2199	-18.5 -18.5 0.45 (1)	10.00			
I-H	0	0	-18.5 -18.5 0.20 (4)	10.00			

TOTAL WEIGHT = 3 X 154 = 462 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.18")
CALCULATED VERT. DEFL. (LL) = L/999 (0.11")
ALLOWABLE DEFL. (TL) = L/360 (1.18")
CALCULATED VERT. DEFL. (TL) = L/999 (0.21")
CSI: TC=0.71 1.00 (A-B:1), BC=0.45 1.00 (M-O:1), WB=0.50 1.00 (A-O:1), SS=0.28 1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (I) (INPUT = 0.90)
JSI METAL= 0.66 (N) (INPUT = 1.00)



Structural component only
DWG# T-2007638

JOB NAME 408223	TRUSS NAME T28	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 5 Oct 2019 MTek Industries, Inc. Tue Apr 28 10:04:10 2020 Page 1	
				ID:DMCubINVR6TsFoe31v8I zns1l-igYGL6Bq_cL45FP4UNTkGGKip777_kbX7PuhzMEM2	

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
R - A	2x4	DRY	No.2
A - C	2x6	DRY	No.2
C - G	2x6	DRY	No.2
G - I	2x4	DRY	No.2
I - O	2x6	DRY	No.2
O - M	2x6	DRY	No.2
M - J	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
R-A	12	TOP
I-J	12	TOP
A-C	12	TOP
C-G	12	TOP
G-I	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
R-O	12	SIDE(0.01)
O-M	12	SIDE(0.01)
M-J	12	TOP
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	RECORD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
R	3373	0	3373	0	0
J	3103	0	3103	0	0

UNFACTORED REACTIONS					
1ST CASE	MAX. MIN.	COMPONENT REACTIONS			
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
R	2380	1591.0	0.0	0.0	0.0
J	2190	1459.0	0.0	0.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.03 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO				FR-TO			
R-A	3316	0.0	0.0 (58.11)	K-I	0	4719	0.58 (11)
A-B	-4149	0	-91.8 (14.11)	A-Q	0	5171	0.84 (11)
B-C	-7288	0	-91.8 (20.11)	K-H	-2757	0	0.44 (11)
C-D	-7288	0	-91.8 (20.11)	Q-B	-2997	0	0.48 (11)
D-S	-8278	0	-91.8 (28.11)	L-H	0	3530	0.44 (11)
S-T	-8278	0	-91.8 (28.11)	B-P	0	3958	0.49 (11)
T-U	-8278	0	-91.8 (28.11)	L-F	-1791	0	0.28 (11)
U-E	-8278	0	-91.8 (28.11)	P-D	-1403	0	0.22 (11)
E-F	-8278	0	-91.8 (21.11)	N-F	0	2134	0.26 (11)
F-G	-6586	0	-91.8 (19.11)	D-N	0	1249	0.15 (11)
G-H	-6586	0	-91.8 (19.11)	N-E	-673	0	0.11 (11)
H-I	-3787	0	-91.8 (13.11)				
J-I	-3042	0	0.0 (51.11)				

R-Q	0	0	-18.5	-18.5	0.04 (4)	10.00
Q-P	0	-4149	-18.5	-18.5	0.30 (11)	10.00
P-V	0	7288	-18.5	-18.5	0.87 (11)	10.00
V-W	0	7288	-18.5	-18.5	0.87 (11)	10.00
W-O	0	7288	-18.5	-18.5	0.87 (11)	10.00
O-X	0	7288	-18.5	-18.5	0.87 (11)	10.00
X-Y	0	7288	-18.5	-18.5	0.87 (11)	10.00
Y-N	0	7288	-18.5	-18.5	0.87 (11)	10.00
N-Z	0	6586	-18.5	-18.5	0.72 (11)	10.00
Z-M	0	6586	-18.5	-18.5	0.72 (11)	10.00
M-L	0	6586	-18.5	-18.5	0.72 (11)	10.00
L-K	0	3787	-18.5	-18.5	0.32 (11)	10.00
K-J	0	0	-18.5	-18.5	0.04 (4)	10.00

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL
S	12-8.4	-88	-88	---	BACK	VERT	TOTAL
T	14-8.4	-88	-88	---	BACK	VERT	TOTAL
U	16-8.4	-88	-88	---	BACK	VERT	TOTAL
V	12-3.8	-1052	-1052	---	BACK	VERT	TOTAL
W	12-8.4	-17	-17	---	BACK	VERT	TOTAL
X	14-8.4	-17	-17	---	BACK	VERT	TOTAL
Y	16-8.4	-17	-17	---	BACK	VERT	TOTAL
Z	18-7.8	-1273	-1273	---	BACK	VERT	TOTAL

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CSI: TC=0.58/1.00 (A/R:1), BC=0.72/1.00 (L/N:1), WB=0.64/1.00 (A/C:1), SSI=0.37/1.00 (L/N:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (I) (INPUT = 0.90)
JSI METAL = 0.73 (M) (INPUT = 1.00)



Structural component only
DWG# T-2007639 1/4

CONTINUED ON PAGE 2


JOB NAME 408223	TRUSS NAME T28	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:10 2020 Page 2 ID:DMCubINVR6TsiFoe3lv6l zns11-iqYGL68q cL45FP4UNTkGGKip777 kbX7PuhzMEMZ	

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-I	MT20	5.0	8.0	2.50	3.25
B	TMWW-I	MT20	5.0	8.0	2.50	2.75
C	TS-I	MT20	3.0	6.0		
D	TMWW-I	MT20	5.0	6.0		
E	TMW+W	MT20	3.0	6.0		
F	TMWW-I	MT20	5.0	6.0		
G	TS-I	MT20	5.0	6.0		
H	TMWW-I	MT20	5.0	6.0	2.50	2.75
I	TMWW-I	MT20	5.0	8.0	2.50	3.25
J	BMV1+P	MT20	3.0	6.0		
K	BMWW-I	MT20	5.0	8.0	2.50	3.25
L	BMWW-I	MT20	5.0	8.0	2.50	2.75
M	BS-I	MT20	5.0	8.0		
N	BMWWW-I	MT20	5.0	8.0		
O	BS-I	MT20	5.0	8.0		
P	BMWW-I	MT20	5.0	6.0	2.50	2.75
Q	BMWW-I	MT20	5.0	8.0	2.50	3.25
R	BMV1+P	MT20	3.0	6.0		


CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

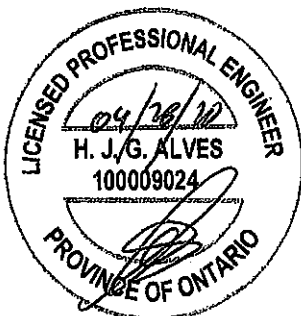

Structural component only
DWG# T-2007639 4/2

JOB NAME 408223	TRUSS NAME T29	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 5 Oct 2019 MITek Industries, Inc. Tue Apr 28 10:04:11 2020 Page 1	
ID:DMCubINVR6TslFoe31v6l zns1l-As6eYSkmbkGfQbeBuiGUoUPDIjsbAtpBlyR7zMEMY				28-11-8 34-10-0	
Scale = 1:54.8					

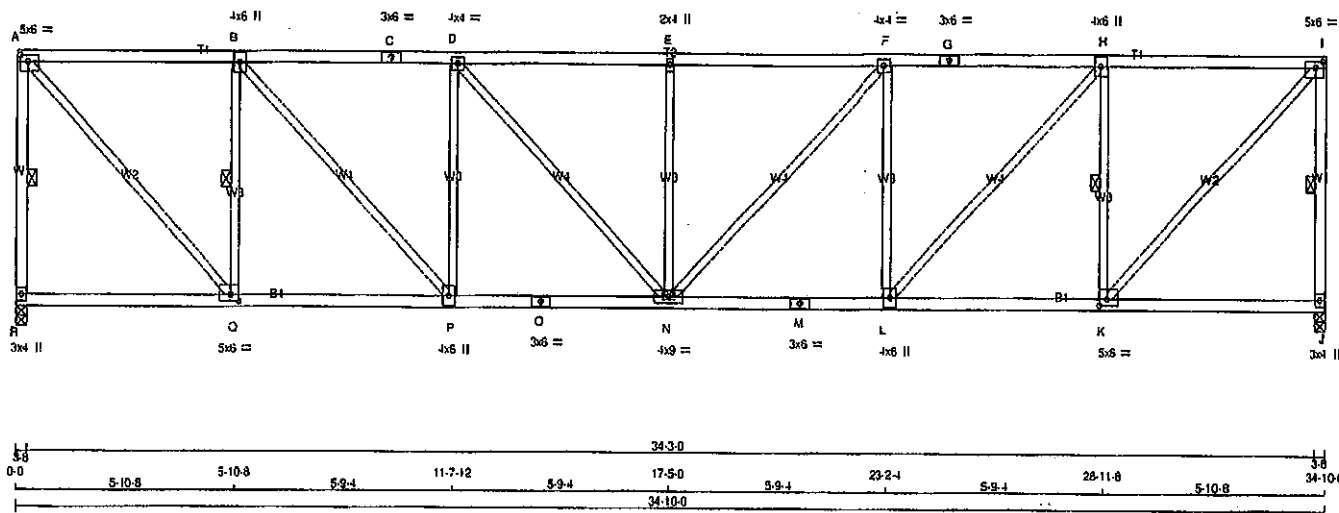

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
R - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
C - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
J - I	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW-1	MT20	5.0	6.0	2.00 2.50
B	TMVW-1	MT20	4.0	6.0	
C	TS-1	MT20	3.0	6.0	
D	TMVW-1	MT20	4.0	4.0	
E	TMVW-1	MT20	2.0	4.0	
F	TMVW-1	MT20	4.0	4.0	
G	TS-1	MT20	3.0	6.0	
H	TMVW-1	MT20	4.0	6.0	
I	TMVW-1	MT20	5.0	6.0	2.00 2.50
J	BMV1+p	MT20	3.0	4.0	
K	BMVW-1	MT20	5.0	6.0	2.00 2.50
L	BMVW-1	MT20	4.0	6.0	
M	BS-1	MT20	3.0	6.0	
N	BMVW-1	MT20	4.0	9.0	
O	BS-1	MT20	3.0	6.0	
P	BMVW-1	MT20	4.0	6.0	
Q	BMVW-1	MT20	5.0	6.0	2.00 2.50
R	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
JT	VERT	HORZ	MAXIMUM FACTORED GROSS REACTION
R	1920	0	1920
J	1920	0	1920

UNFACTORED REACTIONS			
JT	COMBINED	SNOW	LIVE
R	1358	891	0
J	1358	891	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-R, I-J, B-Q, H-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)
R-A	-1878	0	0.0
A-B	-1583	0	0.0
B-C	-2426	0	0.0
C-D	-2426	0	0.0
D-E	-2426	0	0.0
E-F	-2426	0	0.0
F-G	-2426	0	0.0
G-H	-2426	0	0.0
H-I	-1583	0	0.0
I-J	-1878	0	0.0
R-Q	0	0	0.0
Q-P	0	0	0.0
P-O	0	0	0.0
O-N	0	0	0.0
N-M	0	0	0.0
M-L	0	0	0.0
L-K	0	0	0.0
K-J	0	0	0.0

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1/16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.18")
ALLOWABLE DEFL.(TL) = L/360 (1/16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.31")

CSK: TC=0.63/1.00 (F-H:1), BC=0.44/1.00 (N-P:1), WB=0.58/1.00 (F-L:1), SS=0.25/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (A) (INPUT = 0.90)
JSI METAL = 0.78 (M) (INPUT = 1.00)




Structural component only
DWG# T-2007640

JOB NAME 408223	TRUSS NAME T30	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:12 2020 Page 1

ID:DMCubINVR81stFoe31v6l, zns1-e3p0mokOMbs3JPPnBvPxpHb5edJb7s02rcVzZMEMX 34-10-0

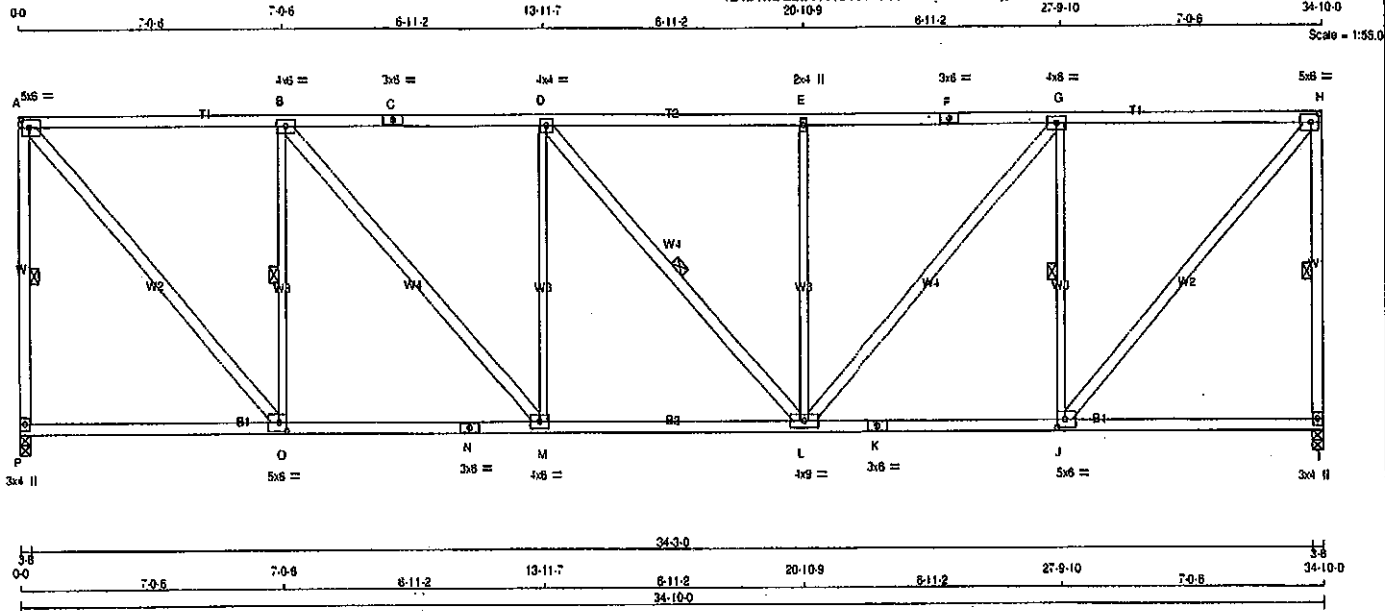

TOTAL WEIGHT = 2 X 179 = 358 lb

LUMBER				N. L. G. A. RULES	
CHORDS	SIZE	LUMBER	DESCR.	SPF	
P - A	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
C - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
I - H	2x4	DRY	No.2	SPF	
P - N	2x4	DRY	No.2	SPF	
N - K	2x4	DRY	No.2	SPF	
K - I	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x4	DRY	No.2	SPF	
O - B	2x3	DRY	No.2	SPF	
M - D	2x3	DRY	No.2	SPF	
L - E	2x3	DRY	No.2	SPF	
J - G	2x3	DRY	No.2	SPF	

ORY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	5.0	6.0	2.50	2.50
B	TMVW-1	MT20	4.0	8.0		
C	TS-1	MT20	3.0	6.0		
D	TMVW-1	MT20	4.0	4.0		
E	TMVW-1	MT20	2.0	4.0		
F	TS-1	MT20	3.0	6.0		
G	TMVW-1	MT20	4.0	6.0		
H	TMVW-1	MT20	5.0	6.0	2.50	2.50
I	BMV1+p	MT20	3.0	4.0		
J	BMVW-1	MT20	5.0	6.0	2.50	2.50
K	BS-1	MT20	3.0	6.0		
L	BMVW-1	MT20	4.0	3.0		
M	BMVW-1	MT20	4.0	8.0		
N	BS-1	MT20	3.0	6.0		
O	BMVW-1	MT20	5.0	6.0	2.50	2.50
P	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
P	1920	0	1920	0	0	3-8	3-8		
I	1920	0	1920	0	0	3-8	3-8		

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
P	1358	891	0	0	0	0	467	0
I	1358	891	0	0	0	0	467	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.60 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-P, H-I, B-O, D-L, G-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX.		MEMB.		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	CS (LBS)	MAX. LENGTH	MEMB.	FORCE (LBS)	MAX. CS (LBS)	MAX. LENGTH	MEMB.
FR-TO					FR-TO				
P-A	-1868	0	0.0	0.0	0.57 (1)	4.91	A-O	0	2158
A-B	-1432	0	-91.8	-91.8	0.78 (1)	4.31	O-B	-1466	0
B-C	-2081	0	-91.8	-91.8	0.89 (1)	3.60	B-M	0	986
C-D	-2081	0	-91.8	-91.8	0.89 (1)	3.60	M-D	-517	0
D-E	-2080	0	-91.8	-91.8	0.88 (1)	4.00	O-L	-2	0
E-F	-2080	0	-91.8	-91.8	0.88 (1)	3.60	L-E	-516	0
F-G	-2080	0	-91.8	-91.8	0.88 (1)	3.60	L-G	0	984
G-H	-1432	0	-91.8	-91.8	0.78 (1)	4.31	J-G	-1465	0
H-I	-1868	0	0.0	0.0	0.57 (1)	4.91	J-H	0	2158
P-O	0	0	-18.5	-18.5	0.22 (4)	10.00			
O-N	0	1432	-18.5	-18.5	0.35 (1)	10.00			
N-M	0	1432	-18.5	-18.5	0.35 (1)	10.00			
M-L	0	2081	-18.5	-18.5	0.42 (1)	10.00			
L-K	0	1432	-18.5	-18.5	0.35 (1)	10.00			
K-J	0	1432	-18.5	-18.5	0.35 (1)	10.00			
J-I	0	0	-18.5	-18.5	0.22 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. O/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 089-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.89(1.00 (E-G:1), BC=0.42(1.00 (L-M:1), WB=0.81(1.00 (D-M:1), SS=0.30(1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618	354	1867 788 1867 1856


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (H) (INPUT = 0.90)
JSI METAL = 0.48 (K) (INPUT = 1.00)



Structural component only
DWG# T-2007641

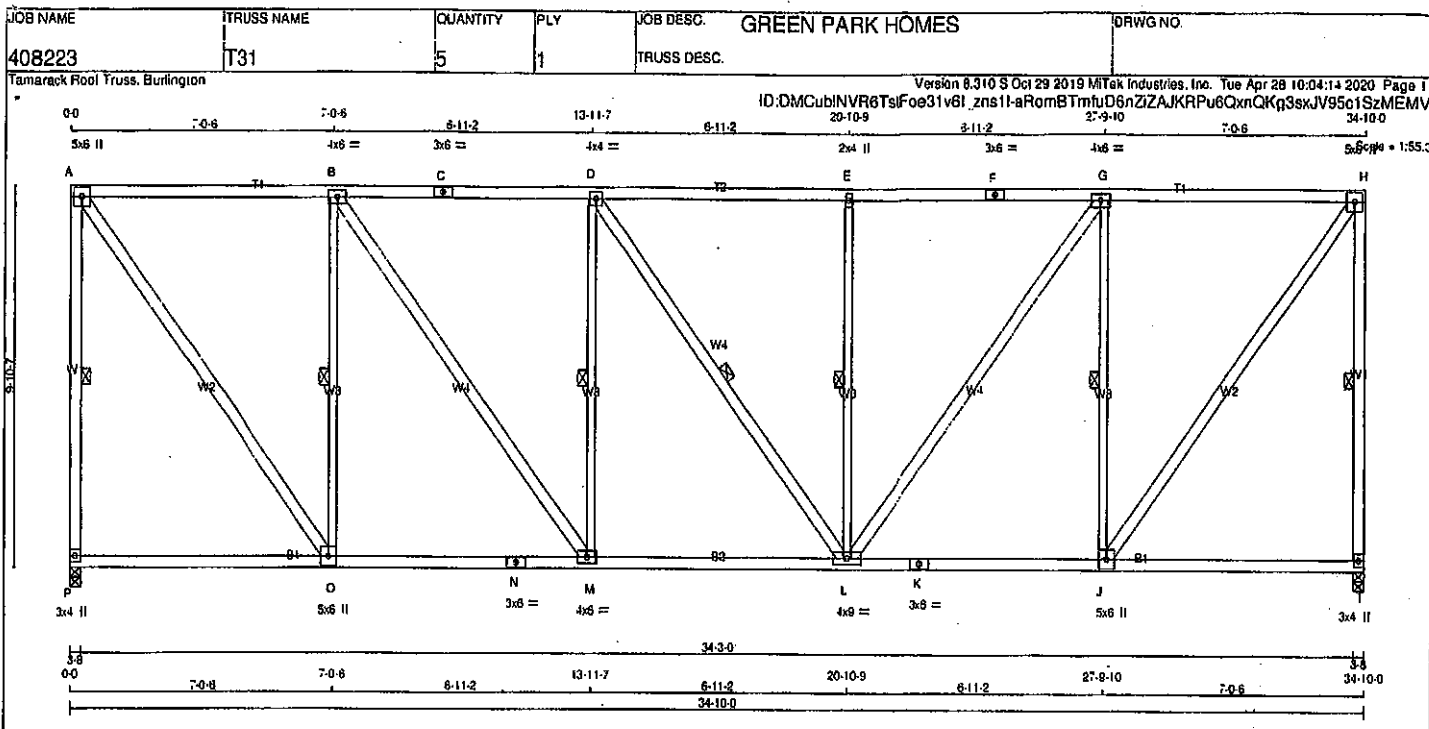

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
P - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
I - H	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
ALL WEBS	2x4	DRY	No.2
EXCEPT			
O - B	2x3	DRY	No.2
M - D	2x3	DRY	No.2
L - E	2x3	DRY	No.2
J - G	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWW+p	MT20	5.0	8.0		
B	TMWW-i	MT20	4.0	8.0		
C	TS-i	MT20	3.0	8.0		
D	TMWW-i	MT20	4.0	8.0		
E	TMWW+w	MT20	2.0	4.0		
F	TS-i	MT20	3.0	8.0		
G	TMWW-i	MT20	4.0	8.0		
H	TMWW+p	MT20	5.0	8.0		
I	BMV-i	MT20	3.0	4.0		
J	BMWW-i	MT20	5.0	8.0		
K	BS-i	MT20	3.0	8.0		
L	BMWW-i	MT20	4.0	8.0		
M	BMWW-i	MT20	4.0	8.0		
N	BS-i	MT20	3.0	8.0		
O	BMWW-i	MT20	5.0	8.0		
P	BMV-i	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

READINGS

FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN
P	1920	0	1920
I	1920	0	1920

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED
P	1358
I	1358

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.96 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-P, H-I, B-O, D-M, O-L, E-L, G-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MEMB.	FORCE	MAX	WEBS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MEMB.	FORCE	MAX
P-A	-1868	0	0.0	0.0	0.88 (1)	4.91	A-O	0	1993	0.32 (1)							
A-B	-1183	0	-91.8	-91.8	0.75 (1)	4.89	O-B	-1488	0	0.96 (1)							
B-C	-1719	0	-91.8	-91.8	0.82 (1)	3.98	B-M	0	916	0.15 (1)							
C-D	-1719	0	-91.8	-91.8	0.82 (1)	3.98	M-D	-817	0	0.41 (1)							
D-E	-1718	0	-91.8	-91.8	0.83 (1)	4.37	D-L	-2	0	0.00 (1)							
E-F	-1718	0	-91.8	-91.8	0.83 (1)	3.96	L-E	-818	0	0.41 (1)							
F-G	-1718	0	-91.8	-91.8	0.83 (1)	3.96	G-L	0	913	0.15 (1)							
G-H	-1183	0	-91.8	-91.8	0.75 (1)	4.89	J-G	-1485	0	0.96 (1)							
H-I	-1868	0	0.0	0.0	0.88 (1)	4.91	J-H	0	2000	0.32 (1)							

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")

CALCULATED VERT. DEFL.(LL) = L/999 (0.11")

ALLOWABLE DEFL.(TL) = L/360 (1.16")

CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CSK TC=0.88/1.00 (H-I), BC=0.38/1.00 (L-M), WB=0.88/1.00 (B-O-I), SS=0.30/1.00 (G-H-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (H) (INPUT = 0.90)

JSI METAL= 0.43 (H) (INPUT = 1.00)




Structural component only
DWG# T-2007642

JOB NAME 408223	TRUSS NAME T32	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:04:15 2020 Page 1

ID:DMCubINVH8TsFoe31v6L_zns11-2dL9OpnHWEeAs8MtIyeRKzCFqhAoVATkprAauzMEMU

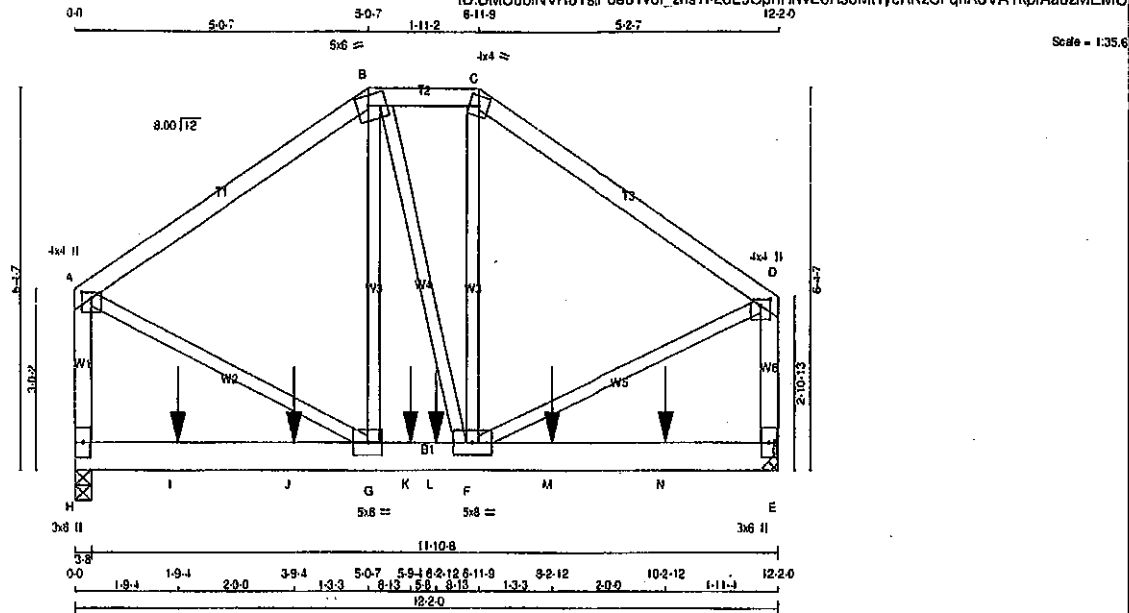

TOTAL WEIGHT = 66 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
A - B	2x4	DRY	No.2		
B - C	2x4	DRY	No.2		
C - D	2x4	DRY	No.2		
H - A	2x4	DRY	No.2		
E - D	2x4	DRY	No.2		
H - E	2x4	DRY	No.2		

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TTWW-m	MT20	5.0	6.0	2.00	2.25
C	TTW-m	MT20	4.0	4.0		
D	TMVW+p	MT20	4.0	4.0	1.25	2.00
E	BMV1+p	MT20	3.0	6.0		
F	BMWWW-i	MT20	5.0	8.0		
G	BMWW-i	MT20	5.0	6.0		
H	BMV1+p	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED	GROSS REACTION	MAXIMUM FACTORED	GROSS REACTION	INPUT	RECORD
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
H	1233	0	1233	0	0
E	1218	0	1218	0	0

A SUITABLE HANGER MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 3-8.

UNFACTORED REACTIONS

JT	1ST LOASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	867	596	0	0	0	0	271	0
E	858	586	0	0	0	0	268	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO									
A-B	-853	0	-91.8	-91.8	0.48	11	5.88	0	122
B-C	-721	0	-91.8	-91.8	0.07	11	6.25	0	34
C-D	-864	0	-91.8	-91.8	0.51	11	5.77	0	154
H-A	-1085	0	0.0	0.0	0.17	11	7.60	0	795
E-D	-1057	0	0.0	0.0	0.16	11	7.63	0	794
H-I	0	0	-18.5	-18.5	0.20	11	10.00	0	0
I-J	0	0	-18.5	-18.5	0.20	11	10.00	0	0
J-G	0	0	-18.5	-18.5	0.20	11	10.00	0	0
G-K	0	711	-18.5	-18.5	0.28	11	10.00	0	0
K-L	0	711	-18.5	-18.5	0.28	11	10.00	0	0
L-F	0	711	-18.5	-18.5	0.28	11	10.00	0	0
F-M	0	0	-18.5	-18.5	0.20	11	10.00	0	0
M-N	0	0	-18.5	-18.5	0.20	11	10.00	0	0
N-E	0	0	-18.5	-18.5	0.20	11	10.00	0	0

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
I	1-9-4	-172	-172	---	BACK	VERT	TOTAL	---	C1
J	3-9-4	-195	-195	---	BACK	VERT	TOTAL	---	C1
K	5-9-4	-187	-187	---	BACK	VERT	TOTAL	---	C1
L	6-2-12	-187	-187	---	BACK	VERT	TOTAL	---	C1
M	8-2-12	-195	-195	---	BACK	VERT	TOTAL	---	C1
N	10-2-12	-172	-172	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLETES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.41")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.41")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CS: TC=0.51 1.00 (C-D:1), 8C=0.28 1.00 (F-G:1), WB=0.20 1.00 (A-G:1), SS=0.20 1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1687
		788	1987
		1658	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.78 (D) INPUT = 0.90
JSI METAL = 0.23 (D) INPUT = 1.00




Structural component only
DWG# T-2007643

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T34S	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 MTech Industries, Inc. Tue Apr 28 10:04:16 2020 Page 1

ID:DMCubINVR6TetFoe31v6l_zns1l-WqvXc9ovQqMVodIZQkUizXVSIESFX?ycZTaj6KzMEMT

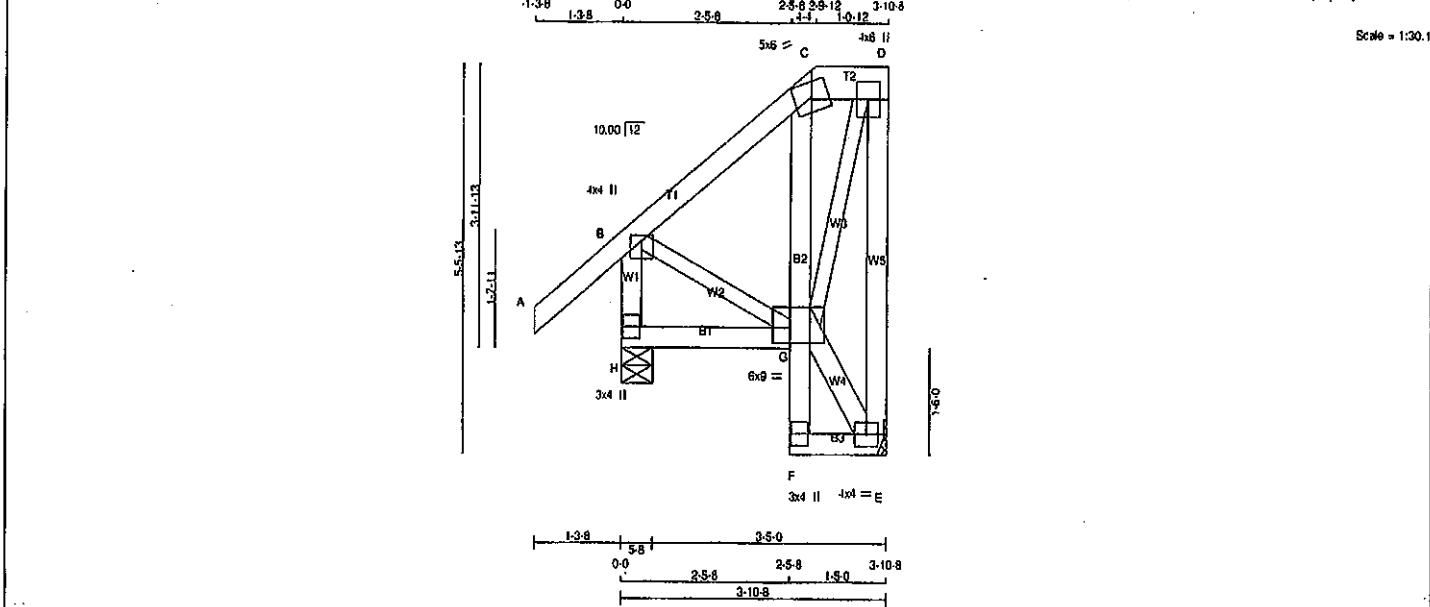

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x6	DRY	No.2
E - D	2x4	DRY	No.2
H - B	2x4	DRY	No.2
H - G	2x4	DRY	No.2
F - C	2x4	DRY	No.2
F - E	2x4	DRY	No.2
ALL WEBS EXCEPT	2x4	DRY	No.2
B - G	2x3	DRY	No.2
G - D	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW+p	MT20	4.0	4.0 1.00 2.00
C	TTV-m	MT20	5.0	5.0
D	TMVW+p	MT20	4.0	5.0
E	BMVW1-l	MT20	4.0	4.0
F	BMV+p	MT20	3.0	4.0
G	BMVWW-l	MT20	6.0	9.0 2.50 3.00
H	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT HORZ	DOWN HORZ UPLIFT	IN-SX	IN-SX
E 214 0	214 0 0	MECHANICAL	
H 341 0	341 0 0	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
E 151	98 0 0 0 0 0 62 0 0 0
H 239	170 0 0 0 0 0 69 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO			
A-B	0 41	-91.8 -91.8 0.14 (5)	10.00
B-C	-62 0	-91.8 -91.8 0.12 (1)	8.25
C-D	-51 0	-91.8 -91.8 0.01 (1)	8.25
E-D	-197 0	0.0 0.0 0.10 (1)	7.81
H-B	-317 0	0.0 0.0 0.03 (1)	7.81
H-G	0 0	-18.5 -18.5 0.04 (4)	10.00
F-G	0 13	0.0 0.0 0.01 (1)	10.00
G-C	-138 0	0.0 0.0 0.01 (1)	7.81
F-E	0 4	-18.5 -18.5 0.01 (4)	10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 2 X 32 = 64 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19')
CALCULATED VERT. DEFL.(LL) = L/989 (0.00')
ALLOWABLE DEFL.(TL) = L/360 (0.19')
CALCULATED VERT. DEFL.(TL) = L/989 (0.00')

CSI: TC=0.14:1.00 (A-B:5), BC=0.04:1.00 (G-H:4), WB=0.03:1.00 (D-G:1), SS=0.09:1.00 (A-B:5)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION	(PSI)	(PL)	(PL)
MAX MIN MAX MIN MAX MIN			
MT20	618	354	1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (8) (INPUT = 0.90)
JSI METAL = 0.06 (8) (INPUT = 1.00)



Structural component only
DWG# T-2007644


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T35S	2	1	TRUSS DESC.		

Tanarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 26 10:04:17 2020 Page 1

ID:DMCubINVR6TstF0e31v8l_zns1l-.07vpVoXB8UMQAHl_S76W2dVdRQGSemC7KGenzMEMS

Scale = 1/23.4

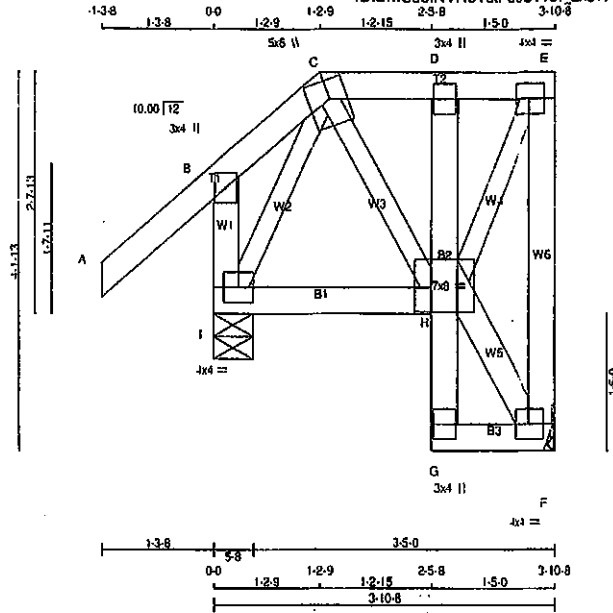

TOTAL WEIGHT = 2 X 29 = 57 LB

LUMBER

N. L. G. A. RULES					
CHORDS	SIZE		LUMBER		DESCR
A - C	2x4	DRY	No.2		SPF
C - E	2x4	DRY	No.2		SPF
F - E	2x4	DRY	No.2		SPF
I - B	2x4	DRY	No.2		SPF
I - H	2x4	DRY	No.2		SPF
G - D	2x4	DRY	No.2		SPF
G - F	2x4	DRY	No.2		SPF
ALL WEBS EXCEPT					
H - F	2x4	DRY	No.2		SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVvp	MT20	3.0	4.0		
C	TTWVvm	MT20	5.0	6.0	2.50	2.25
D	TMVvp	MT20	3.0	4.0		
E	TMVW-i	MT20	4.0	4.0		
F	BMVW-i	MT20	4.0	4.0		
G	BMVvp	MT20	3.0	4.0		
H	BMVWVW-i	MT20	7.0	8.0	3.25	2.25
I	BMVW-i	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
F	191	0	191	0	5-8	5-8
I	363	0	363	0	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST LOOSE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
F	135	85-13	0-0	0-0	0-0	49-0	0-0
I	254	183-0	0-0	0-0	0-0	72-0	0-0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 5.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 41	-91.8 -91.8	0.14 (5)	10.00	H-F	-6 0 0.00 (1)	
B-C	-45 0	-91.8 -91.8	0.14 (5)	6.25	H-E	0 141 0.03 (1)	
C-D	-69 0	-91.8 -91.8	0.02 (1)	6.25	C-H	0 48 0.01 (1)	
D-E	-87 0	-91.8 -91.8	0.02 (1)	6.25	I-C	-96 28 0.02 (1)	
F-E	-175 0	0.0 0.0	0.05 (1)	7.81			
I-B	-255 0	0.0 0.0	0.03 (1)	7.81			
I-H	-13 45	-18.5 -18.5	0.04 (4)	6.25			
G-H	0 13	0.0 0.0	0.01 (1)	10.00			
H-D	-135 0	0.0 0.0	0.01 (1)	7.81			
G-F	0 4	-18.5 -18.5	0.01 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.8 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. GC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.14:1.00 (A-B:5), BC=0.04:1.00 (H-I:4), WB=0.03:1.00 (E-H:1), SSI=0.09:1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR	SECTION
(PSI)	(PLI)
MT20	618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.18 (E) INPUT = 0.90
JSI METAL = 0.09 (B) INPUT = 1.00




Structural component only
DWG# T-2007645

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T36	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:04:18 2020 Page 1

ID:DMCubINVR6TsFoe31v8I zns1I-TC1H0rp9yRcD1KaxY9WL2ybo51I27vNvQn3qBDzMEMR

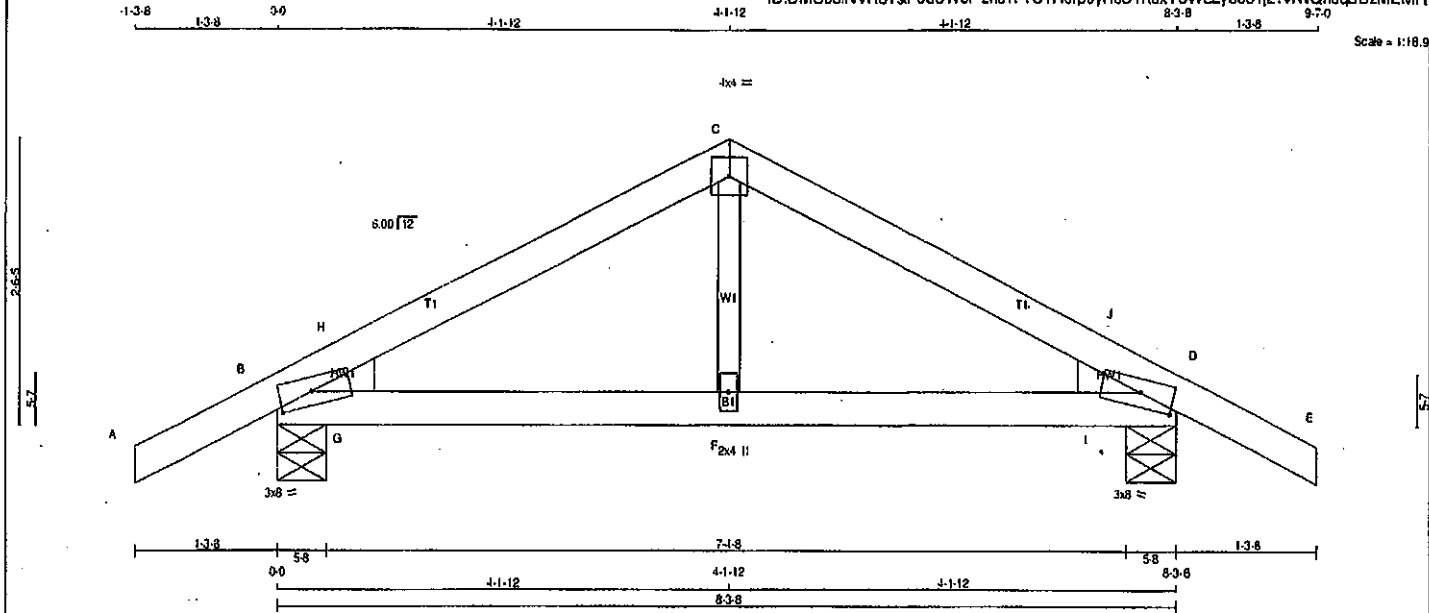

Scale = 1:18.9

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
B - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE				
B TMBH1-m	MT20	3.0	8.0	1.50 3.75
C TTW-p	MT20	4.0	4.0	
D TMBH1-m	MT20	3.0	8.0	1.50 3.75
F BMW-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REGRD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG
B	582 0	582 0	5-8	5-8
D	582 0	582 0	5-8	5-8

UNFACTORED REACTIONS

1ST LOOSE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED SNOW LIVE PERM. LIVE WIND DEAD SOIL
B	409 282 0 0 0 0 0 0 127 0 0 0
D	409 282 0 0 0 0 0 0 127 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED	FORCE	VERT. LOAD	LC1	MAX	MAX. FACTORED	FORCE	VERT. LOAD	LC1	MAX
FR-TO											
A-B	0	23	-91.8	-91.8	0.12 (1)	10.00	F-C	0	170	0.04 (1)	
B-H	-539	0	-91.8	-91.8	0.04 (1)	8.25	G-H	-158	3	0.00 (1)	
H-C	-525	0	-91.8	-91.8	0.15 (1)	8.25	I-J	-158	3	0.00 (1)	
C-J	-525	0	-91.8	-91.8	0.15 (1)	8.25					
J-D	-539	0	-91.8	-91.8	0.04 (1)	8.25					
D-E	0	23	-91.8	-91.8	0.12 (1)	10.00					
B-G	0	465	-18.5	-18.5	0.21 (1)	10.00					
G-F	0	465	-18.5	-18.5	0.21 (1)	10.00					
F-I	0	465	-18.5	-18.5	0.21 (1)	10.00					
I-O	0	465	-18.5	-18.5	0.21 (1)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:	TOP CH.	LL	=	25.6	PSF
	BOT CH.	LL	=	8.0	PSF
	DL	=	0.0	PSF	
	DL	=	7.4	PSF	
	TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. GC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.28")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.28")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.15(1.00 (C-J:1), BC=0.21(1.00 (F-I:1), WB=0.04(1.00 (C-F:1), SS=0.12(1.00 (C-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1687 788 1987 1658


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.25 (B) (INPUT = 0.90)
JSI METAL= 0.11 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007646

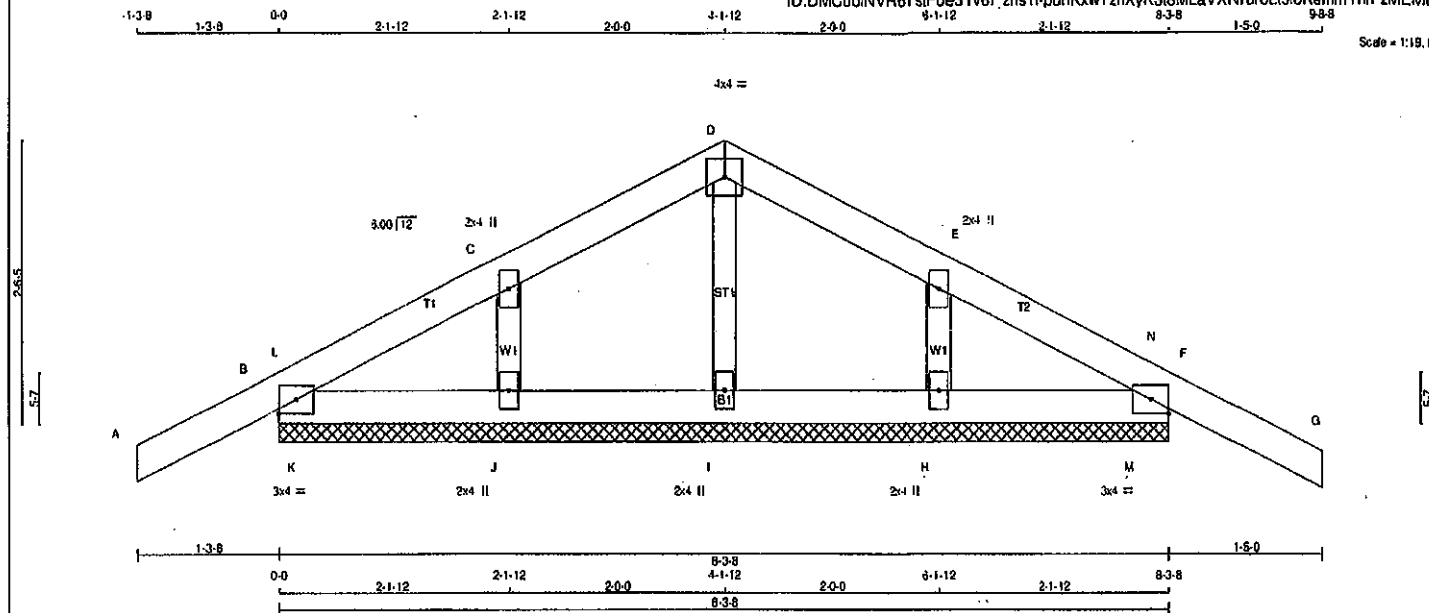

TOTAL WEIGHT = 27 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESIGN
A - D	2x4	DRY	No.2 SPF
D - G	2x4	DRY	No.2 SPF
G - F	2x4	DRY	No.2 SPF
ALL WEBS	2x3	DRY	No.2 SPF
ALL GABLE WEBS	2x3	DRY	No.2 SPF
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y
B	TMB1-I	MT20	3.0	4.0	Edge
C	TMW+*w	MT20	2.0	4.0	
D	TTW-p	MT20	4.0	4.0	
E	TMW+*w	MT20	2.0	4.0	
F	TMB1-I	MT20	3.0	4.0	Edge
H, I, J					
H	RMW1+*w	MT20	2.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT; SH

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)
FR-TO		FROM			FR-TO		
A-B	0 23	-91.8	-91.8 0.12 (1)	10.00	I-D	-115 0	0.02 (1)
B-L	-81 0	-91.8	-91.8 0.01 (4)	8.25	J-C	-218 0	0.03 (1)
L-C	-39 0	-91.8	-91.8 0.06 (1)	8.25	H-E	-218 0	0.03 (1)
C-D	-45 0	-91.8	-91.8 0.06 (1)	8.25	K-L	-52 7	0.00 (1)
D-E	-45 0	-91.8	-91.8 0.06 (1)	8.25	M-N	-52 7	0.00 (1)
E-N	-39 0	-91.8	-91.8 0.06 (1)	8.25			
N-F	-61 0	-91.8	-91.8 0.01 (4)	8.25			
F-G	0 25	-91.8	-91.8 0.14 (1)	10.00			
B-K	0 44	-18.5	-18.5 0.03 (1)	10.00			
K-J	0 44	-18.5	-18.5 0.03 (1)	10.00			
J-I	0 32	-18.5	-18.5 0.02 (1)	10.00			
I-H	0 32	-18.5	-18.5 0.02 (1)	10.00			
H-M	0 44	-18.5	-18.5 0.03 (1)	10.00			
M-E	0 44	-18.5	-18.5 0.03 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	OL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018 , OBC 2012 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

455 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF
LIVE LOAD

CSI: TC=0.14/1.00 (F-G:1) , BC=0.03/1.00 (H-M:1) ,
WB=0.03/1.00 (E-H:1) , SS=0.10/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (B) (INPUT = 0.90)
JSI METAL = 0.09 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007621

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T37	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 28 2019 MTax Industries, Inc. Tue Apr 28 10:04:19 2020 Page 1

ID:DMCubINVR6TstFos31v61_zns11-xPofEBqnlk4fUR761abA7yUR47K12fRpnJfzMEMQ

Scale = 1:17.0

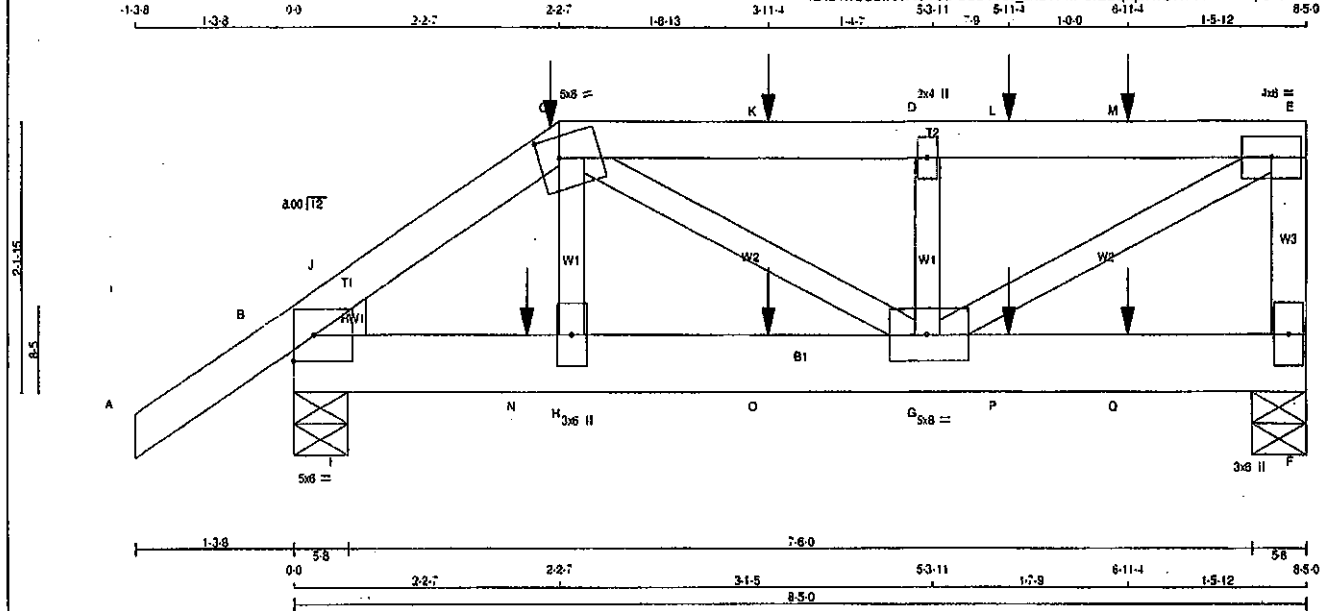

TOTAL WEIGHT = 37 LB (M)

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
F - E	2x4	DRY	No.2
B - F	2x6	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	X
B	TMBH1-I	MT20	5.0	6.0
C	TTWW-m	MT20	5.0	6.0
D	TMMW-w	MT20	2.0	4.0
E	TMMW-v	MT20	4.0	6.0
F	BMV1-p	MT20	3.0	6.0
G	BMWWW-t	MT20	5.0	6.0
H	BMW-w	MT20	3.0	6.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD		HEEL	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORIZ	UPLIFT	BRG IN-SX	BRG IN-SX	WEDGE		
F	537	0	760	0	0	0	5-8	5-8			
B	623	0	623	0	0	0	5-8	5-8			2x4 L

UNFACTORED REACTIONS							
JT	1ST CASE	2ND CASE	3RD CASE	4TH CASE	5TH CASE	6TH CASE	7TH CASE
F	537	352.0	0	0	0	0	0
B	560	392.0	0	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS F, B

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC1)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 26	-91.8	-91.8 0.13 (1)	10.00	H-C	0 73	0.02 (4)
B-J	-1068 0	-91.8	-91.8 0.08 (1)	5.99	C-G	0 252	0.06 (1)
J-C	-860 0	-91.8	-91.8 0.08 (1)	6.25	G-D	-528 0	0.09 (1)
C-K	-923 0	-91.8	-91.8 0.24 (1)	6.09	D-E	0 1062	0.28 (1)
K-D	-923 0	-91.8	-91.8 0.24 (1)	6.09	E-F	0 207	0.00 (1)
D-L	-924 0	-91.8	-91.8 0.24 (1)	6.09			
L-M	-924 0	-91.8	-91.8 0.24 (1)	6.09			
M-E	-924 0	-91.8	-91.8 0.24 (1)	6.09			
F-E	-682 0	0.0	0.0 0.08 (1)	7.81			
B-I	0 701	-18.5	-18.5 0.14 (1)	10.00			
I-N	0 701	-18.5	-18.5 0.14 (1)	10.00			
N-H	0 701	-18.5	-18.5 0.14 (1)	10.00			
H-O	0 705	-18.5	-18.5 0.15 (1)	10.00			
O-G	0 705	-18.5	-18.5 0.15 (1)	10.00			
G-P	0 0	-18.5	-18.5 0.07 (1)	10.00			
P-Q	0 0	-18.5	-18.5 0.07 (1)	10.00			
Q-F	0 0	-18.5	-18.5 0.07 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL
C	2-2-7	-88	-88	FRONT	VERT	TOTAL	C1
K	3-11-4	-83	-83	FRONT	VERT	TOTAL	C1
L	5-11-4	-83	-83	FRONT	VERT	TOTAL	C1
M	6-11-4	-83	-83	FRONT	VERT	TOTAL	C1
N	1-11-4	-48	-48	FRONT	VERT	TOTAL	C1
O	3-11-4	-48	-48	FRONT	VERT	TOTAL	C1
P	5-11-4	-48	-48	FRONT	VERT	TOTAL	C1
Q	8-11-4	-48	-48	FRONT	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN. GC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.28")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.28")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.24/1.00 (D-E:1), BC=0.15/1.00 (G-H:1), WS=0.26/1.00 (E-G:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.81 (E) (INPUT = 0.90)
JSI METAL= 0.24 (E) (INPUT = 1.00)

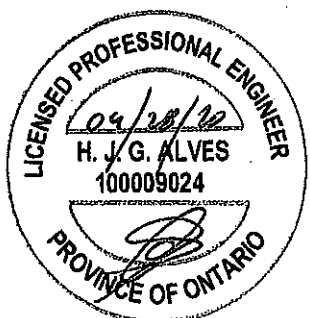

Structural component only
DWG# T-2007647

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T40	1	2	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Tue Apr 28 10:19:57 2020 Page 2

ID:DMCubINVR6TsIFo831v6I_zq81I-TsGG5wA9pyw_Bd8P2IsXoz APYAWTa7LN10dzME7m

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	12.0	1.00	5.50
C	TTWW-m	MT20	7.0	8.0	Edge	
D	TMVW-l	MT20	5.0	6.0		
E	TMVW-w	MT20	3.0	6.0		
F	TS-l	MT20	5.0	6.0		
G	TMVW-l	MT20	5.0	6.0		
H	TTWW-m	MT20	7.0	8.0	Edge	
I	TMVW-p	MT20	4.0	12.0	1.00	5.50
K	BMVW-p	MT20	3.0	6.0		
L	BMVW-l	MT20	5.0	8.0	2.50	3.00
M	BMVW-l	MT20	5.0	6.0	2.50	3.25
N	BS-l	MT20	6.0	9.0		
O	BMVWV-l	MT20	5.0	8.0		
P	BS-l	MT20	6.0	9.0		
Q	BMVW-l	MT20	5.0	8.0	2.50	3.25
R	BMVW-l	MT20	5.0	8.0	2.50	3.00
S	BMVW-p	MT20	3.0	6.0		


Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	17-7-0	-110	-110	---	FRONT	VERT	TOTAL	---	C1
G	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	29-3-8	-429	-429	---	FRONT	VERT	TOTAL	---	C1
L	29-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
M	23-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
N	21-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
O	17-7-0	-26	-26	---	FRONT	VERT	TOTAL	---	C1
P	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Q	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	19-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	21-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	1-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AC	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AD	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AE	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AF	15-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	19-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	25-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	27-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	31-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	33-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

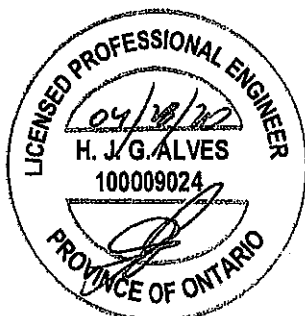

Structural component only
DWG# T-2007660


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	T40Z	1	2	TRUSS DESC.		

Tamarack Road Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:58 2020 Page 1

ID:DMCubINVR6TstF0s31v6I zns11-x2qeJGB0aF2rpnjbcAnm9BWV1eyQ8EpcGa1mZakzME7I

1-3.8 0-0 5-10.8 5-10.8 5-10.14 11-9.6 59-10 17-7.0 18-8.4 20-8.4 22-4.2 23-4.10 5-10.14 29-3.8 5-10.8 35-2.0 36-5.8 1-3.8
Scale = 1:57.6

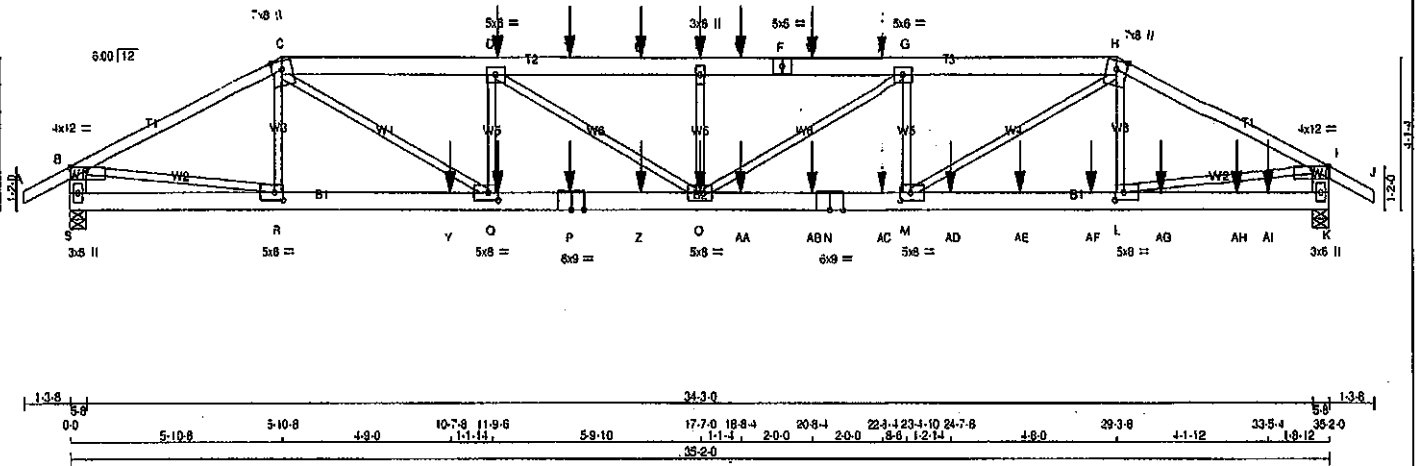

TOTAL WEIGHT = 2 X 169 = 338 lb [M]

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - F	2x6	DRY	No.2	SPF		
F - H	2x6	DRY	No.2	SPF		
H - J	2x4	DRY	No.2	SPF		
S - B	2x6	DRY	No.2	SPF		
K - I	2x6	DRY	No.2	SPF		
S - P	2x6	DRY	1650F 1.5E	SPF		
P - N	2x6	DRY	1650F 1.5E	SPF		
N - K	2x6	DRY	1650F 1.5E	SPF		

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C 1	12	TOP
H-J 1	12	TOP
C-F 2	12	SIDE(183.1)
F-H 2	12	SIDE(0.0)
9-B 2	12	TOP
K-I 2	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
S-P 2	12	SIDE(183.1)
P-N 2	12	SIDE(183.1)
N-K 2	12	SIDE(0.0)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLYS FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING DESIGNER									
BEARINGS									
FACTORED			MAXIMUM FACTORED			INPUT	REQD		
GROSS REACTION			GROSS REACTION			GRG	GRG		
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
S	4181	0	4161	0	0	5-8	5-8		
K	5042	0	5042	0	0	5-8	5-8		

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
S	2935	1965	0	0	0	970	0
K	3552	2409	0	0	0	1143	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.95 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 28	-91.8 -91.8	0.07 (1)	10.00	R-C	-470 0	0.06 (1)
B-C	-8650 0	-91.8 -91.8	0.66 (1)	3.34	C-Q	0 5608	0.89 (1)
C-D	-10735 0	-91.8 -91.8	0.33 (1)	3.55	Q-D	-1878 0	0.20 (1)
D-T	-12119 0	-91.8 -91.8	0.40 (1)	3.30	D-O	0 1838	0.20 (1)
T-U	-12119 0	-91.8 -91.8	0.40 (1)	3.30	O-E	-1004 0	0.12 (1)
U-E	-12119 0	-91.8 -91.8	0.40 (1)	3.30	C-G	-46 33	0.02 (1)
E-V	-12119 0	-91.8 -91.8	0.45 (1)	3.23	M-G	-826 0	0.10 (1)
V-F	-12119 0	-91.8 -91.8	0.45 (1)	3.23	M-H	0 5832	0.72 (1)
F-W	-12119 0	-91.8 -91.8	0.45 (1)	3.23	L-H	0 57	0.01 (4)
W-X	-12119 0	-91.8 -91.8	0.45 (1)	3.23	B-R	0 8014	0.74 (1)
X-G	-12119 0	-91.8 -91.8	0.45 (1)	3.23	L-I	0 7274	0.90 (1)
G-H	-12159 0	-91.8 -91.8	0.39 (1)	3.30			
H-I	-8042 0	-91.8 -91.8	0.81 (1)	2.95			
I-J	0 28	-91.8 -91.8	0.07 (1)	10.00			
S-B	-4141 0	0.0 0.0	0.15 (1)	7.00			
K-I	-4926 0	0.0 0.0	0.17 (1)	8.55			

S-R	0 0	-18.5 -18.5 0.05 (1)	10.00
R-Y	0 5974	-18.5 -18.5 0.44 (1)	10.00
Y-Q	0 5974	-18.5 -18.5 0.44 (1)	10.00
Q-P	0 10734	-18.5 -18.5 0.54 (1)	10.00
P-Z	0 10734	-18.5 -18.5 0.54 (1)	10.00
Z-O	0 10734	-18.5 -18.5 0.54 (1)	10.00
O-AA	0 12159	-18.5 -18.5 0.71 (1)	10.00
AA-AB	0 12159	-18.5 -18.5 0.71 (1)	10.00
AB-N	0 12159	-18.5 -18.5 0.71 (1)	10.00
N-AC	0 12159	-18.5 -18.5 0.71 (1)	10.00
AC-M	0 12159	-18.5 -18.5 0.71 (1)	10.00
M-AD	0 7208	-18.5 -18.5 0.69 (1)	10.00
AD-AE	0 7208	-18.5 -18.5 0.69 (1)	10.00
AE-AF	0 7208	-18.5 -18.5 0.69 (1)	10.00
AF-L	0 7208	-18.5 -18.5 0.69 (1)	10.00
L-AG	0 0	-18.5 -18.5 0.16 (1)	10.00
AG-AH	0 0	-18.5 -18.5 0.16 (1)	10.00
AH-AI	0 0	-18.5 -18.5 0.16 (1)	10.00
AI-K	0 0	-18.5 -18.5 0.16 (1)	10.00

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
D	11-11.4	-110	-110	---	BACK	VERT	TOTAL	---	C1
E	17-7.0	-110	-110	---	BACK	VERT	TOTAL	---	C1
O	17-7.0	-26	-26	---	BACK	VERT	TOTAL	---	C1
P	13-11.4	-26	-26	---	BACK	VERT	TOTAL	---	C1

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.32')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/718 (0.58')
CSI: TC=0.81 (H-I), BC=0.71 (M-O), I: WB=0.90 (L-I), SSI=0.84 (L-M)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (PSI) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1857 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (R) (INPUT = 0.89)
JSI METAL = 0.93 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007661

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T40Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:19:58 2020 Page 2

ID:DMCubNVR8TslFoe31v6l_zns1l-x2qeJGBQaF2mnibcaNm9BWHeyQ8EpcGa1mZAkzME7l

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	12.0	1.00	5.50
C	TTWW+m	MT20	7.0	8.0	Edge	
D	TMVW-t	MT20	5.0	8.0		
E	TMVW+w	MT20	3.0	8.0		
F	TS-t	MT20	5.0	8.0		
G	TMVW-t	MT20	5.0	8.0		
H	TTWW+m	MT20	7.0	8.0	Edge	
I	TMVW-p	MT20	4.0	12.0	1.00	5.50
K	BMV1+p	MT20	3.0	8.0		
L	BMVW-t	MT20	5.0	8.0	2.50	3.00
M	BMVW-t	MT20	5.0	8.0	2.50	3.25
N	BS-t	MT20	6.0	9.0		
O	BMVW-t	MT20	5.0	8.0		
P	BS-t	MT20	6.0	9.0		
Q	BMVW-t	MT20	5.0	8.0	2.50	3.25
R	BMVW-t	MT20	5.0	8.0	2.50	3.00
S	BMV1+p	MT20	3.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DJR.	TYPE	HEEL	CONN.
Q	11-11-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
T	13-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
U	15-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	18-8-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
W	20-8-4	-159	-159	---	BACK	VERT	TOTAL	---	C1
X	22-8-4	-159	-159	---	BACK	VERT	TOTAL	---	C1
Y	10-7-8	-1171	-1171	---	BACK	VERT	TOTAL	---	C1
Z	15-11-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
AA	18-8-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
AB	20-8-4	-32	-32	---	BACK	VERT	TOTAL	---	C1
AC	22-8-4	-32	-32	---	BACK	VERT	TOTAL	---	C1
AD	24-7-8	-2237	-2237	---	BACK	VERT	TOTAL	---	C1
AE	26-6-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AF	28-6-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AG	30-6-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AH	32-6-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AI	33-5-4	-121	-121	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

11 C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007661 *72*

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T41	2	1	GREEN PARK HOMES	


Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 26 10:19:59 2020 Page 1

ID:DMCubINVR6TstFoe31v6l zns11-PFO0WcCQLZAIQxloAHu7hO3QDMnRzl7PphW7AzME7K

1-3-8 0-0 4-0-8 1-0-8 3-10-9 7-10-8 8-6-1 14-4-9 8-4-13 20-9-7 8-6-1 27-3-8 31-1-8 35-2-0 38-5-8 1-3-8

Scale = 1:67.6

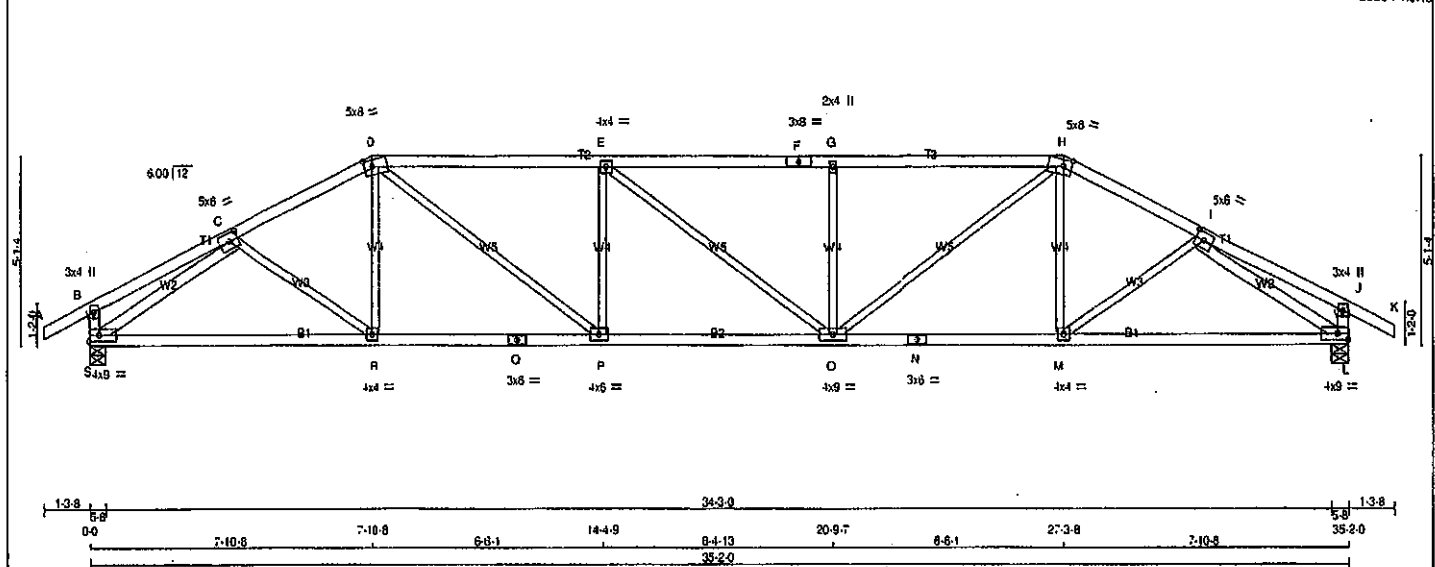

TOTAL WEIGHT = 2 X 139 = 278 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	BEARINGS	FACTORED	MAXIMUM FACTORED
A - D	2x4	DRY	No.2	SPF	JOINT	GROSS REACTION	GROSS REACTION
D - F	2x4	DRY	No.2	SPF	JOINT	VERT	DOWN
F - H	2x4	DRY	No.2	SPF	JOINT	HORIZ	HORIZ
H - K	2x4	DRY	No.2	SPF	JOINT	UPLIFT	UPLIFT
S - B	2x4	DRY	No.2	SPF	JOINT	IN-SX	IN-SX
L - J	2x4	DRY	No.2	SPF	JOINT	IN-SX	IN-SX
S - Q	2x4	DRY	No.2	SPF	JOINT	IN-SX	IN-SX
Q - N	2x4	DRY	No.2	SPF	JOINT	IN-SX	IN-SX
N - L	2x4	DRY	No.2	SPF	JOINT	IN-SX	IN-SX
ALL WEBS	2x3	DRY	No.2	SPF	JOINT	IN-SX	IN-SX
EXCEPT							
S - C	2x4	DRY	No.2	SPF	JOINT	IN-SX	IN-SX
I - L	2x4	DRY	No.2	SPF	JOINT	IN-SX	IN-SX

DRY: SEASONED LUMBER.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2016

PLATES (table is in inches)				LOADING			
JT TYPE	PLATES	W	LEN	Y	X	CHORDS	WEBS
A - B	TMV-p	MT20	3.0	4.0		MAX. FACTORED	MAX. FACTORED
B - C	TMVW-t	MT20	5.0	8.0	2.50 2.75	VERT. LOAD	VERT. LOAD
C - D	TTWW-m	MT20	5.0	8.0	2.25 2.75	MAX. FACTORED	MAX. FACTORED
D - E	TMVW-t	MT20	4.0	4.0		VERT. LOAD	VERT. LOAD
E - F	TS-t	MT20	3.0	8.0		MAX. FACTORED	MAX. FACTORED
F - G	TMVW-w	MT20	2.0	4.0		VERT. LOAD	VERT. LOAD
G - H	TTWW-m	MT20	5.0	8.0	2.25 2.75	MAX. FACTORED	MAX. FACTORED
H - I	TMVW-t	MT20	5.0	8.0	2.50 2.75	VERT. LOAD	VERT. LOAD
I - J	TMV-p	MT20	3.0	4.0		MAX. FACTORED	MAX. FACTORED
J - K	BMVW-t	MT20	4.0	9.0	Edge	VERT. LOAD	VERT. LOAD
K - L	BMVW-t	MT20	4.0	9.0	Edge	MAX. FACTORED	MAX. FACTORED
L - M	BS-t	MT20	3.0	8.0		VERT. LOAD	VERT. LOAD
M - N	BMVW-t	MT20	4.0	9.0		MAX. FACTORED	MAX. FACTORED
N - O	BS-t	MT20	4.0	9.0		VERT. LOAD	VERT. LOAD
O - P	BMVW-t	MT20	4.0	9.0		MAX. FACTORED	MAX. FACTORED
P - Q	BS-t	MT20	3.0	8.0		VERT. LOAD	VERT. LOAD
Q - R	BMVW-t	MT20	4.0	9.0		MAX. FACTORED	MAX. FACTORED
R - S	BS-t	MT20	3.0	8.0		VERT. LOAD	VERT. LOAD
S - T	BMVW-t	MT20	4.0	9.0	Edge	MAX. FACTORED	MAX. FACTORED

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2016

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")

CALCULATED VERT. DEFL.(LL) = L/999 (0.21")

ALLOWABLE DEFL.(TL) = L/360 (1.17")

CALCULATED VERT. DEFL.(TL) = L/999 (0.41")

CSI: TC=0.96/1.00 (D-E:1), BC=0.64/1.00 (O-P:1).

WB=0.83/1.00 (I-L:1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE FEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.89 (I) (INPUT = 0.90)

JSI METAL= 0.77 (N) (INPUT = 1.00)

Structural component only

DWG# T-2007662

JOB NAME 408224	TRUSS NAME T42	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 28 2019 MTek Industries, Inc. Tue Apr 28 10:20:01 2020 Page 1	
ID:DMCubINVR8TstFoe31v8l_zns11-LdWnxHEglAQPgFSAHixTmP8J9V7RFJIG7?En3zME7i				35-24 38-5-8	
1-3-8 0-0 5-0-8 5-0-8 1-10-0 3-10-8 7-8-8 17-7-0 7-8-8 25-3-8 1-10-0 30-1-0 5-0-8 1-3-8				Scale = 1:57.6	

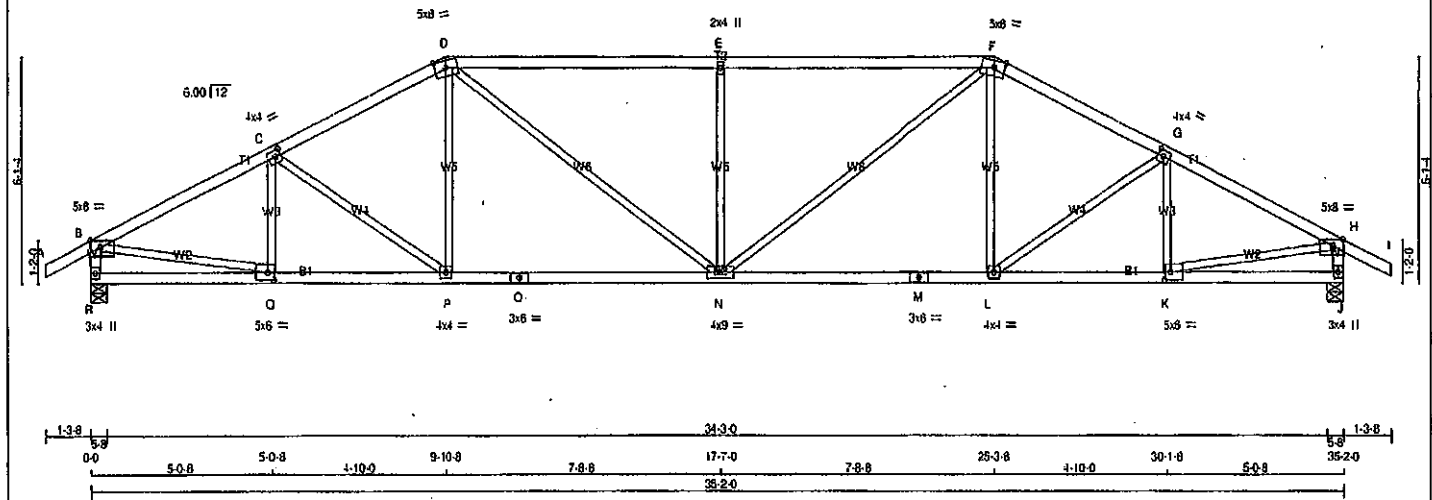

LUMBER		DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY		DESIGN CRITERIA	
N. L. G. A. RULES		BUILDING DESIGNER		SPECIFIED LOADS:	
CHOROS	SIZE	BEARINGS		TOP CH. LL = 25.6 PSF	
A - D	2x4 DRY No.2	FACTORED		DL = 8.0 PSF	
D - F	2x4 DRY No.2	GROSS REACTION		BOT CH. LL = 0.0 PSF	
F - I	2x4 DRY No.2	DOWN		DL = 7.4 PSF	
R - B	2x4 DRY No.2	UP		TOTAL LOAD = 39.0 PSF	
J - H	2x4 DRY No.2	UNFACTORED REACTIONS		SPACING = 24.0 IN. GC	
H - O	2x4 DRY No.2	1ST CASE		LOADING IN FLAT SECTION BASED ON A SLOPE	
O - M	2x4 DRY No.2	COMBINED		OF 8.0:12	
M - J	2x4 DRY No.2	SNOW		THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR	
ALL WEBS	2x3 DRY No.2	LIVE		SMALL BUILDING REQUIREMENTS OF PART 9.	
EXCEPT		PERM. LIVE		NBCC 2010, NBCC 2015	
DRY, SEASONED LUMBER.		WIND		THIS DESIGN COMPLIES WITH:	
		DEAD		- PART 9 OF CBC 2018, CBC 2012, ABC 2019	
		SOIL		- PART 9 OF CBC 2012 (2019 AMENDMENT)	
				- CSA 086-09, CSA 086-14	
				- TPIC 2011, TPIC 2014	
				155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN	
				LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF	
				LIVE LOAD	
				ALLOWABLE DEFL.(LL) = L/360 (1.17")	
				CALCULATED VERT. DEFL.(LL) = L/999 (0.17")	
				ALLOWABLE DEFL.(TL) = L/360 (1.17")	
				CALCULATED VERT. DEFL.(TL) = L/999 (0.34")	
				CSI: TC=0.97 1.00 (D-E:1), 6C=0.51 1.00 (P-Q:1),	
				WB=0.58/1.00 (B-Q:1), SSI=0.34/1.00 (D-E:1)	
				DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10	
				COMP=1.10 SHEAR=1.10 TENS=1.10	
				COMPANION LIVE LOAD FACTOR = 1.00	
				TRUSS PLATE MANUFACTURER IS NOT	
				RESPONSIBLE FOR QUALITY CONTROL IN THE	
				TRUSS MANUFACTURING PLANT.	
				NAIL VALUES	
				PLATE GRIP(DRY) SHEAR SECTION	
				(PSI) (PL) (PL)	
				MAX MIN MAX MIN MAX MIN	
				MT20 618 354 1667 788 1987 1656	
				PLATE PLACEMENT TOL. = 0.250 inches	
				PLATE ROTATION TOL. = 5.0 Deg.	
				JSI GRIP= 0.87 (FI) (INPUT = 0.90)	
				JSI METAL= 0.75 (MI) (INPUT = 1.00)	

PLATES (table in inches)	
JT TYPE	PLATES
B TMVW-p	MT20 5.0 8.0 Edge 3.50
C TMVW-l	MT20 4.0 4.0 2.00 1.75
D TTWW-m	MT20 5.0 8.0 2.25 3.75
E TMVW-w	MT20 2.0 4.0
F TTWW-m	MT20 5.0 8.0 2.25 3.75
G TMVW-l	MT20 4.0 4.0 2.00 1.75
H TMVW-p	MT20 5.0 8.0 Edge 3.50
J BMVl+p	MT20 3.0 4.0
K BMVW-l	MT20 5.0 8.0 2.50 2.00
L BMVW-l	MT20 4.0 4.0
M BS-l	MT20 3.0 6.0
N BMVW-w-l	MT20 4.0 9.0
O BS-l	MT20 3.0 6.0
P BMVW-l	MT20 4.0 4.0
Q BMVW-l	MT20 5.0 8.0 2.50 2.00
R BMVl+p	MT20 3.0 4.0


Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.



Structural component only
DWG# T-2007663

JOB NAME 408224	TRUSS NAME T43	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:20:02 2020 Page 1
 ID:DMCubINVR6TstFoe31v6l_zns1l-q498dEteUYGHO1NrQSIh1h7BZrVAiQsViknJVzME7h
 1-3-8 0-0 6-0-8 4-0-8 5-10-0 11-10-8 5-8-8 17-7-0 5-8-8 23-3-8 5-10-0 29-1-8 8-0-8 35-2-0 36-5-8
 1-3-8 0-0 6-0-8 5-0-8 5-10-0 11-10-8 5-8-8 17-7-0 5-8-8 23-3-8 5-10-0 29-1-8 6-0-8 33-2-0
 Scale = 1:57.6

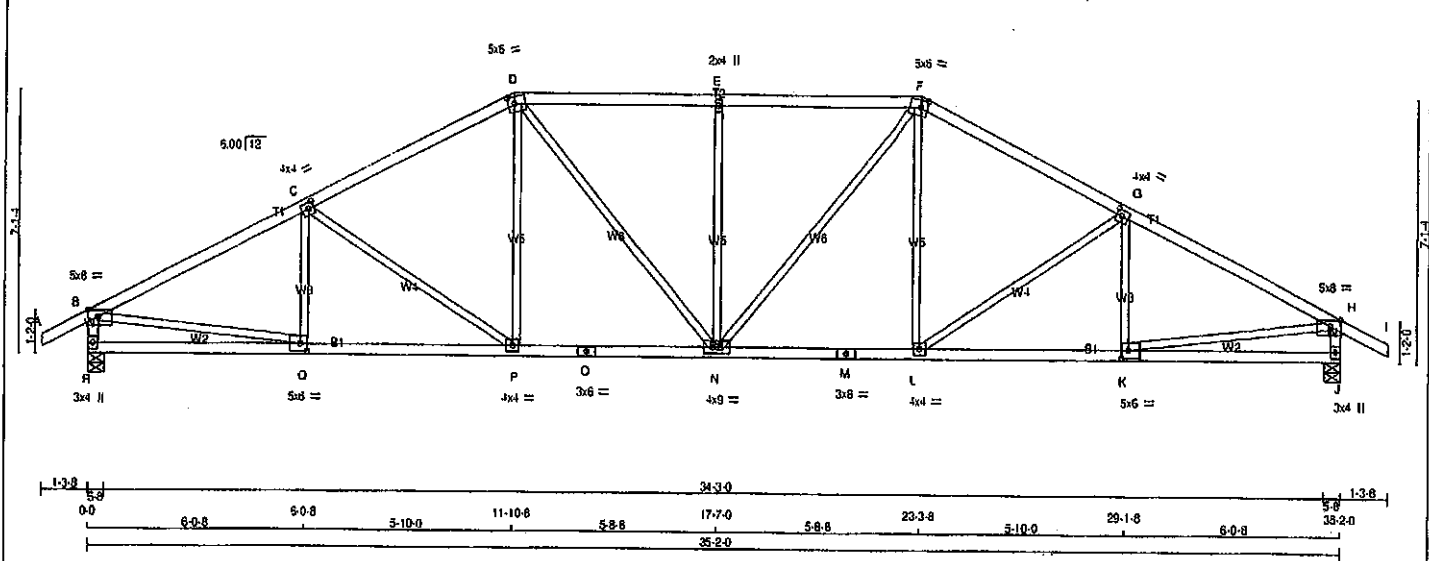

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
O - F	2x4	DRY	No.2
O - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	8.0	Edge	3.50
C TMVW-t	MT20	4.0	4.0	2.00	1.75
D TTWW-m	MT20	5.0	8.0	2.25	2.00
E TMVW-t	MT20	2.0	4.0		
F TTWW-m	MT20	5.0	8.0	2.25	2.00
G TMVW-t	MT20	4.0	4.0	2.00	1.75
H TMVW-p	MT20	5.0	8.0	Edge	3.50
J BMV1+p	MT20	3.0	4.0		
K BMVW-t	MT20	5.0	8.0	2.50	2.25
L BMVW-t	MT20	4.0	4.0		
M BS-t	MT20	3.0	6.0		
N BMVW-t	MT20	4.0	4.0		
O BS-t	MT20	3.0	6.0		
P BMVW-t	MT20	4.0	4.0		
Q BMVW-t	MT20	5.0	8.0	2.50	2.25
R BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
R	2083	0	2083	0	5-8	5-8
J	2083	0	2083	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE COMBINED		MAX. MIN. COMPONENT REACTIONS			
	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1457	989	0	0	0	488
J	1457	989	0	0	0	488

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		MAX. UNBRACED LENGTH	MEMB.	WEBS		MAX. UNBRACED LENGTH
	MAX. FORCE (LBS)	FACTORED (PLF)	VERT. LOAD (LBS)	CS1 (LBS)			MAX. FORCE (LBS)	FACTORED (PLF)	
FR-TO						FR-TO			
A-B	0	28	-91.8	-91.8	10.00	Q-C	-255	12	0.07 (1)
B-C	-2889	0	-91.8	-91.8	5.58 (1)	C-P	-435	0	0.42 (1)
C-D	-2539	0	-91.8	-91.8	5.52 (1)	P-D	0	350	0.08 (1)
D-E	-2559	0	-91.8	-91.8	4.48 (1)	O-N	0	482	0.11 (1)
E-F	-2559	0	-91.8	-91.8	4.48 (1)	N-E	-841	0	0.58 (1)
F-G	-2539	0	-91.8	-91.8	5.52 (1)	L-F	0	482	0.11 (1)
G-H	-2889	0	-91.8	-91.8	5.58 (1)	L-F	0	350	0.08 (1)
H-I	0	28	-91.8	-91.8	10.00	L-G	-435	0	0.42 (1)
I-B	-2014	0	0.0	0.0	0.20 (1)	K-G	-255	12	0.07 (1)
J-H	-2014	0	0.0	0.0	0.20 (1)	B-Q	0	2835	0.59 (1)
R-Q	0	0	-18.5	-18.5	0.15 (4)	K-H	0	2835	0.59 (1)
Q-P	0	2809	-18.5	-18.5	0.49 (1)				
P-O	0	2249	-18.5	-18.5	0.43 (1)				
O-N	0	2249	-18.5	-18.5	0.43 (1)				
N-M	0	2249	-18.5	-18.5	0.43 (1)				
M-L	0	2249	-18.5	-18.5	0.43 (1)				
L-K	0	2608	-18.5	-18.5	0.49 (1)				
K-J	0	0	-18.5	-18.5	0.15 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
 OL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA D88-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
 CALCULATED VERT. DEFL.(LL) = L/999 (0.15)
 ALLOWABLE DEFL.(TL) = L/360 (1.17)
 CALCULATED VERT. DEFL.(TL) = L/999 (0.28)

CSI: TC=0.59/1.00 (H-K:1), 8C=0.49/1.00 (K-L:1), WB=0.59/1.00 (H-K:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788


PLATE PLACEMENT TOL. = 0.250 inches
 PLATE ROTATION TOL. = 5.0 Deg.
 JSI GRIP = 0.89 (Q) (INPUT = 0.90)
 JSI METAL = 0.69 (M) (INPUT = 1.00)



Structural component only
 DWG# T-2007664

JOB NAME 408224	TRUSS NAME T44	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:20:03 2020 Page 1
 ID:DMCubINVR6TstFoe31v6l zns1f10dXmZFWOog7vYcZP7zxsEE72zACv9c7kLJKrXzME7g
 1-3-8 0-0 7-0-8 7-0-8 5-10-0 13-10-8 3-8-8 17-7-0 3-8-8 21-3-8 4-10-0 28-1-8 7-0-8 35-2-0 1-3-8
 Scale = 1:50.0

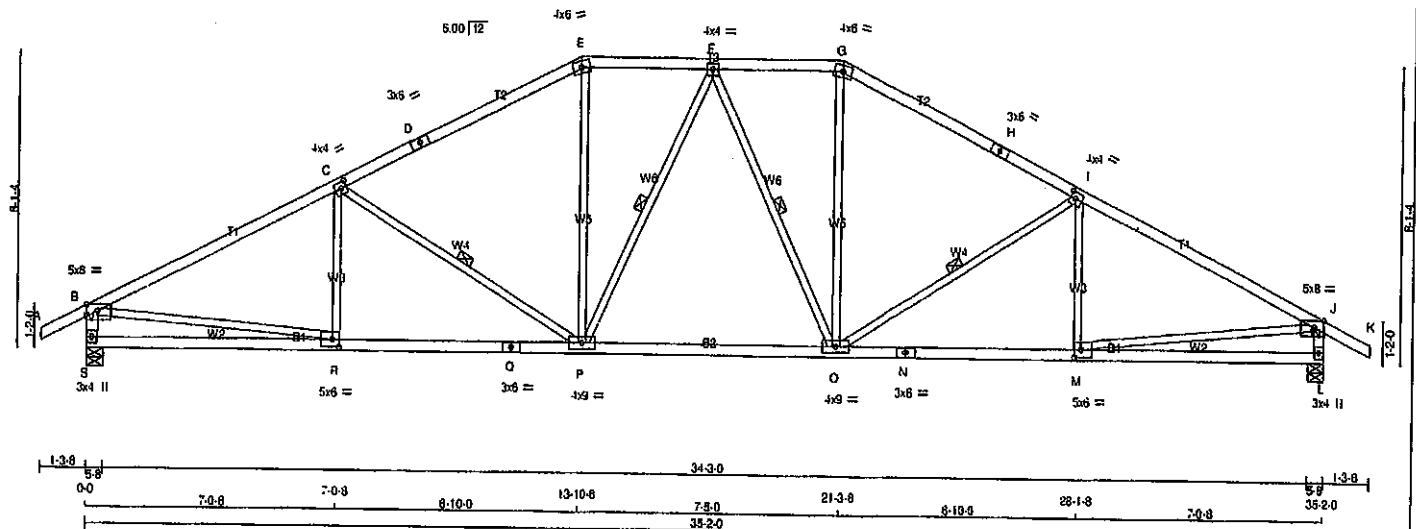

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY No.2	SPF
D - E	2x4	DRY No.2	SPF
E - G	2x4	DRY No.2	SPF
G - H	2x4	DRY No.2	SPF
H - K	2x4	DRY No.2	SPF
S - B	2x4	DRY No.2	SPF
L - J	2x4	DRY No.2	SPF
S - Q	2x4	DRY No.2	SPF
Q - N	2x4	DRY No.2	SPF
N - L	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (Table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	8.0	Edge 3.50
C	TMVW-l	MT20	4.0	4.0	2.00 1.75
D	TS-l	MT20	3.0	6.0	
E	TTW-m	MT20	4.0	6.0	
F	TMVW-l	MT20	4.0	4.0	
G	TTW-m	MT20	4.0	6.0	
H	TS-l	MT20	3.0	6.0	
I	TMVW-l	MT20	4.0	4.0	2.00 1.75
J	TMVW-p	MT20	5.0	8.0	Edge 3.50
L	BMV-l+p	MT20	3.0	4.0	
M	BMVW-l	MT20	5.0	6.0	2.50 2.25
N	BS-l	MT20	3.0	6.0	
O	BMVW-l	MT20	4.0	9.0	
P	BMVW-l	MT20	4.0	9.0	
Q	BS-l	MT20	3.0	6.0	
R	BMVW-l	MT20	5.0	6.0	2.50 2.25
S	BMV-l+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG	
S	2063 0	2063 0	0 0	5-8 5-8	
L	2063 0	2063 0	0 0	5-8 5-8	

UNFACTORED REACTIONS					
JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS			
S	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL			
L	1457	999 0 0 0 0 0 0 0 0 0 0			

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-P, F-P, F-O, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO				FR-TO			
A-B	0 28	-91.8 -91.8 0.12 (1)	10.00	R-C	-182 52	0.08 (1)	
B-C	-2906 0	-91.8 -91.8 0.83 (1)	3.25	C-P	-637 0	0.29 (1)	
C-D	-2373 0	-91.8 -91.8 0.72 (1)	3.66	P-E	0 674	0.15 (1)	
D-E	-2373 0	-91.8 -91.8 0.72 (1)	3.66	F-F	-222 0	0.11 (1)	
E-F	-2100 0	-91.8 -91.8 0.19 (1)	4.53	F-O	-222 0	0.11 (1)	
F-G	-2100 0	-91.8 -91.8 0.19 (1)	4.53	O-G	0 674	0.15 (1)	
G-H	-2373 0	-91.8 -91.8 0.72 (1)	3.66	O-I	-637 0	0.29 (1)	
H-I	-2373 0	-91.8 -91.8 0.72 (1)	3.66	M-I	-182 52	0.08 (1)	
I-J	-2906 0	-91.8 -91.8 0.83 (1)	3.25	B-R	0 2849	0.80 (1)	
J-K	0 28	-91.8 -91.8 0.12 (1)	10.00	M-J	0 2849	0.80 (1)	
S-B	-2008 0	0.0 0.0 0.20 (1)	5.96				
L-J	-2008 0	0.0 0.0 0.20 (1)	5.96				
S-R	0 0	-18.5 -18.5 0.20 (4)	10.00				
R-Q	0 2630	-18.5 -18.5 0.52 (1)	10.00				
Q-P	0 2630	-18.5 -18.5 0.52 (1)	10.00				
P-O	0 2193	-18.5 -18.5 0.45 (1)	10.00				
O-N	0 2630	-18.5 -18.5 0.52 (1)	10.00				
N-M	0 2630	-18.5 -18.5 0.52 (1)	10.00				
M-L	0 0	-18.5 -18.5 0.20 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.30")

CSI: TC=0.83/1.00 (A-J), BC=0.52/1.00 (M-O), WB=0.60/1.00 (J-M), SI=0.28/1.00 (B-C)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (M) (INPUT = 0.90)
 JSI METAL = 0.79 (Q) (INPUT = 1.00)



Structural component only
 DWG# T-2007665

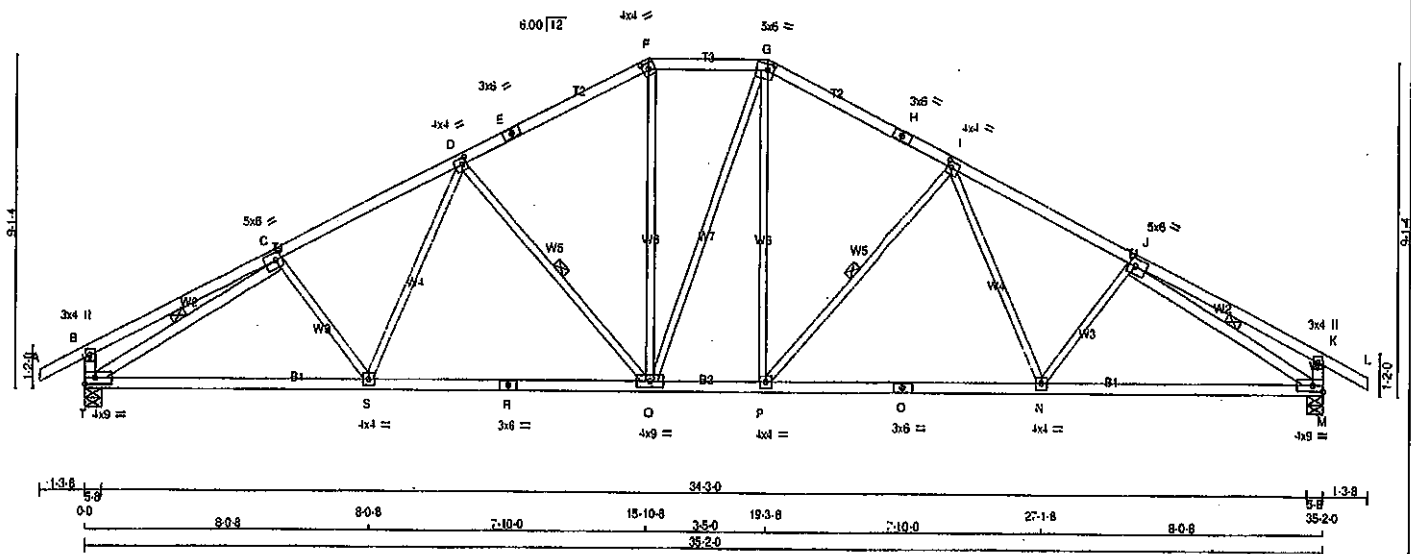

LUMBER			
N L G A	RULES		
CHORDS	SIZE	LUMBER	DESCR.
A - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - L	2x4	DRY	No.2
T - B	2x4	DRY	No.2
M - K	2x4	DRY	No.2
T - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
T - C	2x4	DRY	No.2
J - M	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV-w	MT20	3.0	4.0	
C	TMWW-I	MT20	5.0	6.0	2.50 2.25
D	TMWW-I	MT20	4.0	4.0	2.00 1.50
E	TS-I	MT20	3.0	6.0	
F	TTW-h	MT20	4.0	4.0	2.00 1.75
G	TTWW-m	MT20	5.0	6.0	2.00 2.00
H	TS-I	MT20	3.0	6.0	
I	TMWW-I	MT20	4.0	4.0	2.00 1.50
J	TMWW-I	MT20	5.0	6.0	2.50 2.25
K	TMV-w	MT20	3.0	4.0	
M	BMVW-I	MT20	4.0	9.0	Edge
N, P, S					
N	BMWW-I	MT20	4.0	4.0	
O	BS-I	MT20	3.0	6.0	
Q	BMWWWW-I	MT20	4.0	9.0	
R	BS-I	MT20	3.0	6.0	
T	BMVW-I	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQ'D BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
T	2083	0	2083	0	0	5-8	5-8
1	0000	0	0000	0			

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
T	1457	989 0	0 0	0 0	0 0	488 0	0 0
M	1457	989 0	0 0	0 0	0 0	488 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T. M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.86 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1: 2 LENGTH OF D-Q, I-P, C-T, J-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS :				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO		LENGTH	FR-TO		
A-B	0 28	-91.8	-91.8	0.12 (1)	C-S	-110 37	0.04 (1)
B-C	0 20	-91.8	-91.8	0.32 (1)	S-D	0 276	0.08 (1)
C-D	-2760 0	-91.8	-91.8	0.40 (1)	D-Q	-682 0	0.31 (1)
D-E	-2187 0	-91.8	-91.8	0.36 (1)	Q-G	0 614	0.14 (1)
E-F	-2187 0	-91.8	-91.8	0.38 (1)	C-F	0 4	0.00 (1)
F-G	-1925 0	-91.8	-91.8	0.18 (1)	P-G	0 609	0.14 (1)
G-H	-2185 0	-91.8	-91.8	0.38 (1)	I-J	-683 0	0.31 (1)
H-I	-2185 0	-91.8	-91.8	0.38 (1)	N-J	0 279	0.06 (1)
I-J	-2761 0	-91.8	-91.8	0.40 (1)	K-N	-110 37	0.04 (1)
J-K	0 20	-91.8	-91.8	0.32 (1)	T-C	-3042 0	0.61 (1)
K-L	0 28	-91.8	-91.8	0.12 (1)	J-M	-3043 0	0.61 (1)
T-B	-325 0	0.0	0.0	0.03 (1)			
M-K	-325 0	0.0	0.0	0.03 (1)			
T-S	0 2537	-18.5	-18.5	0.56 (1)			
S-R	0 2363	-18.5	-18.5	0.53 (1)			
R-Q	0 2363	-18.5	-18.5	0.53 (1)			
Q-P	0 1924	-18.5	-18.5	0.40 (1)			
P-O	0 2362	-18.5	-18.5	0.53 (1)			
O-N	0 2362	-18.5	-18.5	0.53 (1)			
N-M	0 2538	-18.5	-18.5	0.56 (1)			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2010, OBC 2012, ABC 2018
 - PART 9 OF OBC 2012 (2019 AMENOMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

455 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF
LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL)= L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.29")

CSI: TC=0.40/1.00 (I-J:1) , BC=0.58/1.00 (M-N:1) ,
WB=0.61/1.00 (J-M:1) , SSI=0.20/1.00 (G-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.89 (F) (INPUT = 0.90)
JSI METAL = 0.83 (O) (INPUT = 1.00)



Structural component only
DWG# T-2007666

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T46	8	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:20:05 2020 Page 1
ID:DMCubINVR6TstFos31v8! zns1i-EOlnIHbWFr9smYVYQxJYonsa171BczRwqzME78
352-0 36-5-8
13-8
Scale = 1:58.2

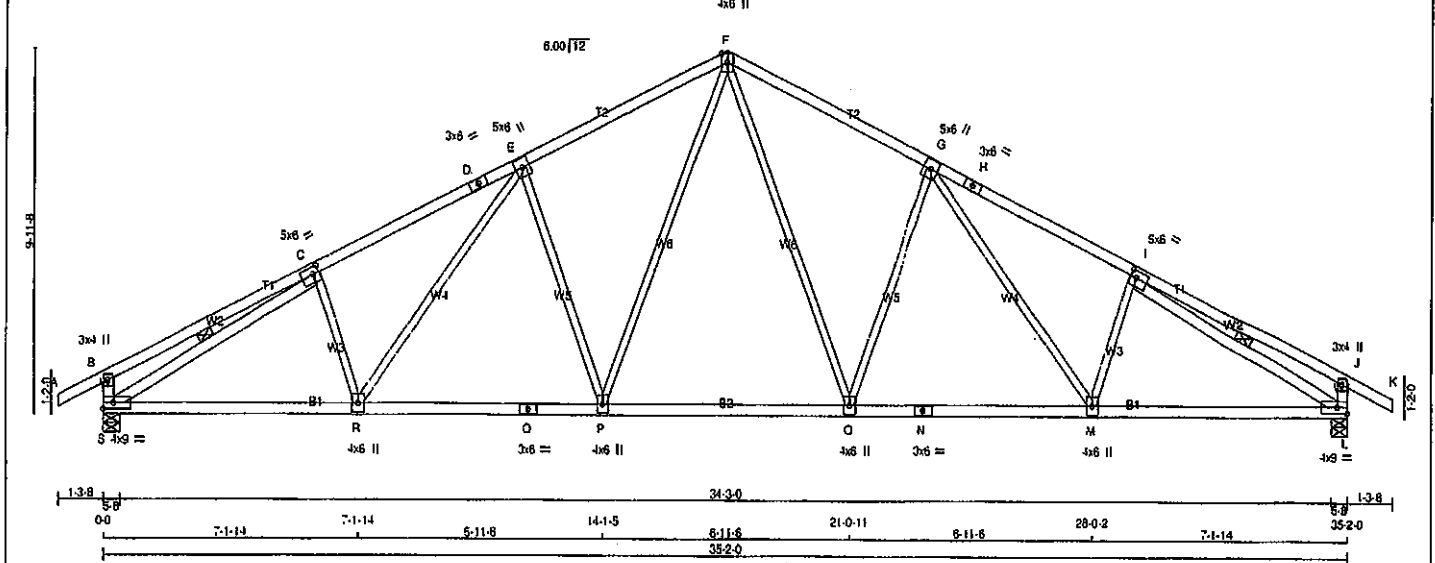

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - K	2x4	DRY	No.2	SPF	
S - B	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
S - Q	2x4	DRY	No.2	SPF	
Q - N	2x4	DRY	No.2	SPF	
N - L	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
S - C	2x4	DRY	No.2	SPF	
I - L	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-1	MT20	5.0	6.0	2.25	2.00
D	TS-1	MT20	3.0	6.0		
E	TMWW+1	MT20	5.0	6.0		
F	TTWW+p	MT20	4.0	6.0	Edge	
G	TMWW+1	MT20	5.0	6.0		
H	TS-1	MT20	3.0	6.0		
I	TMWW-1	MT20	5.0	6.0	2.25	2.00
J	TMV+p	MT20	3.0	4.0		
L	BMVW1-1	MT20	4.0	9.0	Edge	
M, O, P, R						
M	BMVW+1	MT20	4.0	6.0		
N	BS-1	MT20	3.0	6.0		
Q	BS-1	MT20	3.0	6.0		
S	BMVW1-1	MT20	4.0	9.0	Edge	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
S	2063	0	2063	0
L	2063	0	2063	0

UNFACTORED REACTIONS

1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT	1457	989.0	0.0	0.0	488.0	0.0
S	1457	989.0	0.0	0.0	488.0	0.0
L	1457	989.0	0.0	0.0	488.0	0.0

SEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-S, I-L

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORZ. LOAD (LBS)
FR-TO						FR-TO			
A-B	0 28	-91.8	-91.8	0.12 (1)	10.00	F-O	0 866	0.19 (1)	
B-C	0 22	-91.8	-91.8	0.40 (1)	10.00	D-G	-728 0	0.72 (1)	
C-D	-2868 0	-91.8	-91.8	0.49 (1)	3.75	G-M	0 391	0.09 (1)	
D-E	-2868 0	-91.8	-91.8	0.49 (1)	3.75	M-I	-192 18	0.05 (1)	
E-F	-2322 0	-91.8	-91.8	0.46 (1)	4.07	P-F	0 866	0.19 (1)	
F-G	-2322 0	-91.8	-91.8	0.46 (1)	4.07	E-P	-728 0	0.72 (1)	
G-H	-2868 0	-91.8	-91.8	0.49 (1)	3.75	R-E	0 391	0.09 (1)	
H-I	-2868 0	-91.8	-91.8	0.49 (1)	3.75	C-R	-192 18	0.05 (1)	
I-J	0 22	-91.8	-91.8	0.40 (1)	10.00	S-C	-3064 0	0.72 (1)	
J-K	0 28	-91.8	-91.8	0.12 (1)	10.00	I-L	-3064 0	0.72 (1)	
S-B	-344 0	0.0	0.0	0.03 (1)	7.81				
L-J	-344 0	0.0	0.0	0.03 (1)	7.81				
S-R	0 2574	-18.5	-18.5	0.53 (1)	10.00				
R-Q	0 2291	-18.5	-18.5	0.47 (1)	10.00				
Q-P	0 2291	-18.5	-18.5	0.47 (1)	10.00				
P-O	0 1762	-18.5	-18.5	0.36 (1)	10.00				
O-N	0 2291	-18.5	-18.5	0.47 (1)	10.00				
N-M	0 2291	-18.5	-18.5	0.47 (1)	10.00				
M-L	0 2574	-18.5	-18.5	0.53 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.28")

CSI: TC=0.49/1.00 (C-E:1), BC=0.53/1.00 (L-M:1), WB=0.72/1.00 (E-P:1), SSI=0.22/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618, 354, 1687, 788, 1987, 1658	

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (C) (INPUT = 0.90)
JSI METAL = 0.77 (I) (INPUT = 1.00)



Structural component only
DWG# T-2007667

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T47S	2	1	GREEN PARK HOMES	

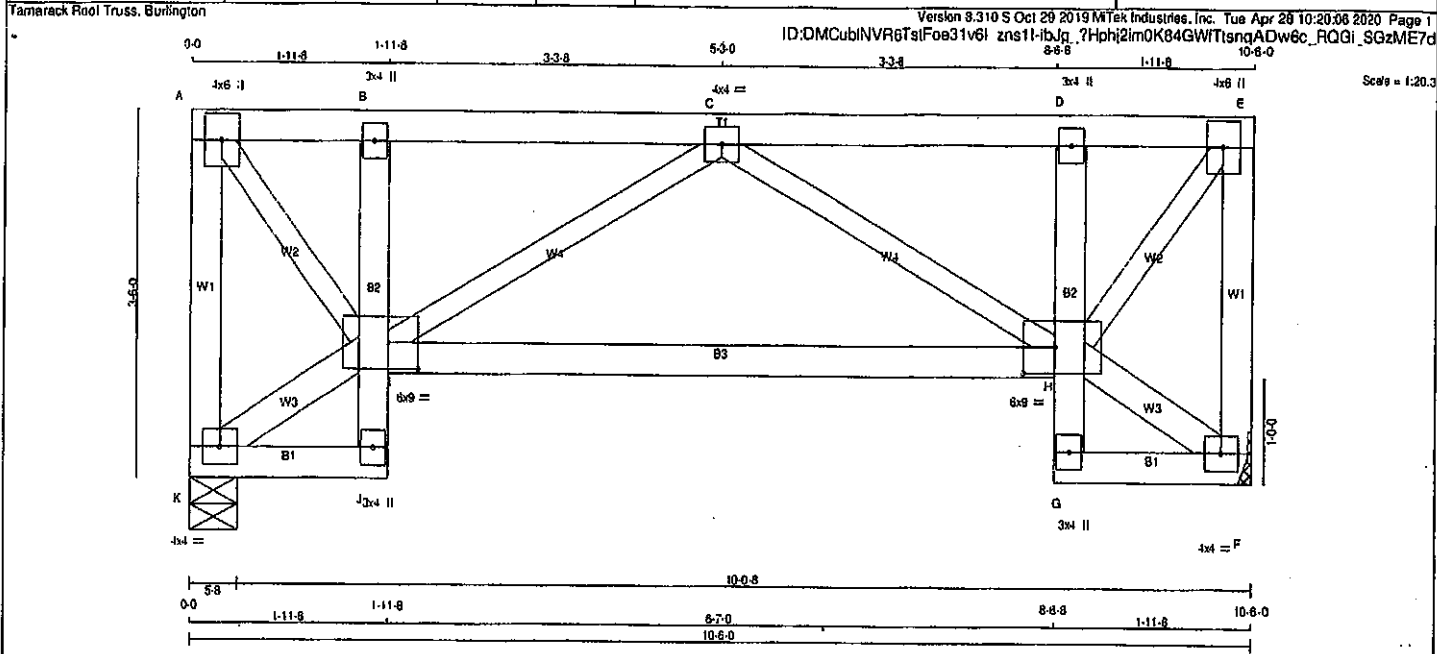

LUMBER				TOTAL WEIGHT = 2 X 51 = 102 lb			
N. L. G. A. RULES				(M/F)			
CHORDS	SIZE	DRY	LUMBER	DESCR.			
K - A	2x4	DRY	No.2	SPF			
A - E	2x4	DRY	No.2	SPF			
F - E	2x4	DRY	No.2	SPF			
K - J	2x4	DRY	No.2	SPF			
J - B	2x4	DRY	No.2	SPF			
I - H	2x4	DRY	No.2	SPF			
G - D	2x4	DRY	No.2	SPF			
G - F	2x4	DRY	No.2	SPF			
ALL WEBS	2x3	DRY	No.2	SPF			
EXCEPT							
K - I	2x4	DRY	No.2	SPF			
H - F	2x4	DRY	No.2	SPF			

DRY: SEASONED LUMBER.

PLATES (table in inches)				TOTAL LOAD CASES: (4)			
JT	TYPE	PLATES	W	LEN	Y	X	
A	TMVW+p	MT20	4.0	6.0			
B	TMV+p	MT20	3.0	4.0			
C	TMVW-i	MT20	4.0	4.0			
D	TMV+p	MT20	3.0	4.0			
E	TMVW+p	MT20	4.0	6.0			
F	BMVW-i	MT20	4.0	4.0			
G	BMV+p	MT20	3.0	4.0			
H	BVMWVW-i	MT20	6.0	9.0	3.00	3.50	
I	BVMWVW-i	MT20	6.0	9.0	3.00	3.50	
J	BMV+p	MT20	3.0	4.0			
K	BMVW-i	MT20	4.0	4.0			

Structural component only
DWG# T-2007688

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING

BEARINGS

FACTORED	MAXIMUM FACTORED	INPUT	REQD				
GROSS REACTION	GROSS REACTION	BRG	BRG				
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
K	697	0	697	0	0	5-8	5-8
F	697	0	697	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	504	269	0	0	0	235	0
F	504	269	0	0	0	235	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. (PLF)	FACTORED LG1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. (PLF)	FACTORED LG1 MAX CSI (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
K-A	-667	0	0.0	0.0	0.17	(1)	7.81
A-B	-497	0	-114.3	-114.3	0.14	(1)	6.25
B-C	-508	0	-114.3	-114.3	0.22	(1)	8.25
C-D	-508	0	-114.3	-114.3	0.22	(1)	8.25
D-E	-497	0	-114.3	-114.3	0.14	(1)	6.25
E-F	-667	0	0.0	0.0	0.17	(1)	7.81
K-J	0	25	-18.5	-18.5	0.03	(4)	10.00
J-I	0	19	0.0	0.0	0.05	(1)	10.00
I-B	-331	0	0.0	0.0	0.05	(1)	7.81
I-H	0	832	-18.5	-18.5	0.48	(4)	10.00
G-H	0	19	0.0	0.0	0.05	(1)	10.00
H-D	-331	0	0.0	0.0	0.05	(1)	7.81
G-F	0	25	-18.5	-18.5	0.03	(4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 15.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 48.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.22/1.00 (B-C:1), BC=0.46/1.00 (H-I:4), WB=0.24/1.00 (E-H:1), SS=0.22/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PL)	(PL)
	MAX MIN	MAX MIN	MAX MIN
MT20	818	354	1687
	788	1987	1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.77 (H) INPUT = 0.90
JSI METAL= 0.30 (E) INPUT = 1.00

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T48	1	1	GREEN PARK HOMES	
TAMARACK ROOF TRUSS, BURLINGTON		TRUSS DESC.		Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:20:07 2020 Page 1	

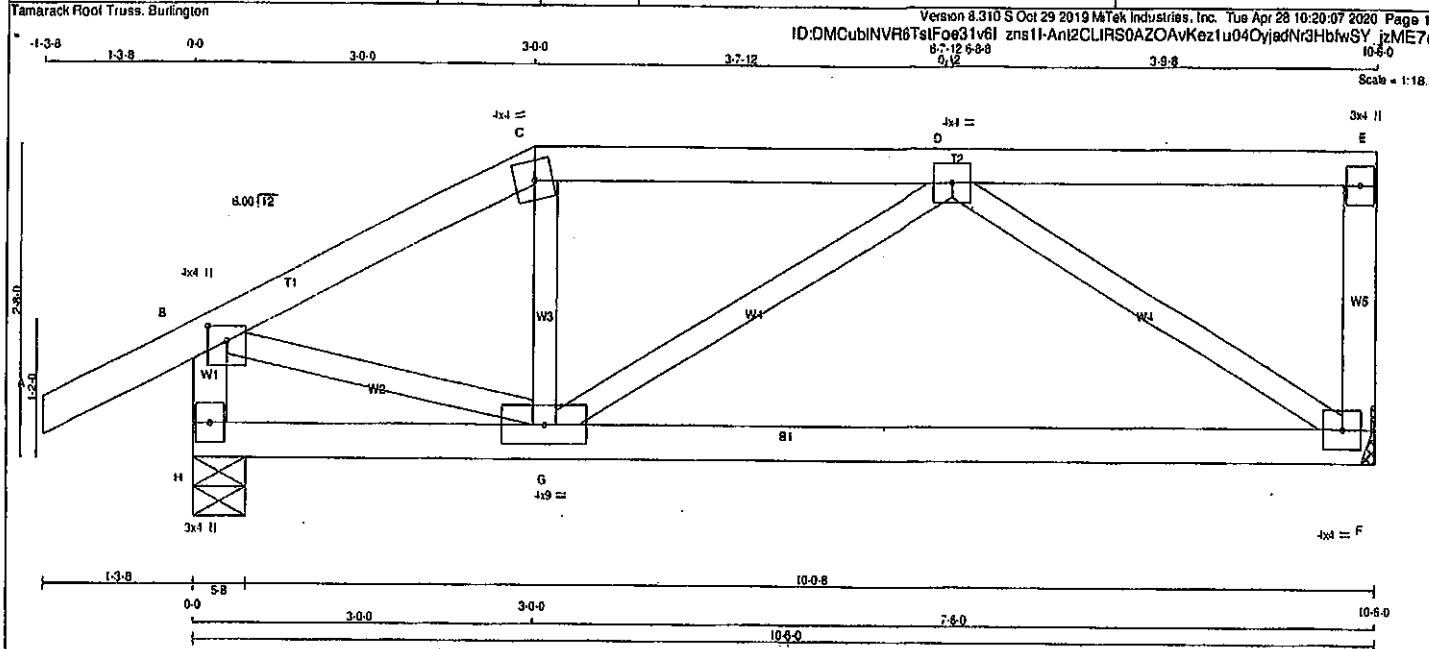

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
F - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

PLATES (table is in inches)			
JT TYPE	PLATES	W	LEN Y X
B	TMVW+p	MT20	4.0 4.0 1.50 2.00
C	TYW-m	MT20	4.0 4.0
D	TMVW-i	MT20	4.0 4.0
E	TMV+p	MT20	3.0 4.0
F	BMVW1-i	MT20	4.0 4.0
G	BMVW1-i	MT20	4.0 9.0
H	BMV1+p	MT20	3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
BEARINGS							
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG			
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
F	579	0	579	0	0	MECHANICAL	
H	703	0	703	0	0	5-8	5-8

UNFACTORED REACTIONS							
JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	409	269	0	0	0	141	0
H	495	338	0	0	0	157	0

LOADING							
TOTAL LOAD CASES: (4)							
CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM TO		FR-TO			
A-B	0	28	-91.8 -91.8 0.12 (1)	10.00	G-C	0	61
B-C	-635	0	-91.8 -91.8 0.15 (1)	6.25	G-D	-61	60
C-D	-569	0	-91.8 -91.8 0.21 (1)	6.25	D-F	-731	0
D-E	0	0	-91.8 -91.8 0.20 (1)	10.00	B-G	0	587
F-E	-135	0	0.0 0.0 0.02 (1)	7.81			
H-B	-699	0	0.0 0.0 0.07 (1)	7.81			
H-G	0	0	-18.5 -18.5 0.21 (4)	10.00			
G-F	0	619	-18.5 -18.5 0.25 (4)	10.00			

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF
SPACING	= 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")

CALCULATED VERT. DEFL.(LL) = L/999 (0.01")

ALLOWABLE DEFL.(TL) = L/360 (0.35")

CALCULATED VERT. DEFL.(TL) = L/999 (0.09")

CSF: TC=0.21 (1.00 (C-D:1), BC=0.25 (1.00 (F-G:4), WB=0.23 (1.00 (D-F:1), SS=0.17 (1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

MAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	619 354 1687 789 1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.68 (B) (INPUT = 0.90)

JSI METAL = 0.23 (F) (INPUT = 1.00)



Structural component only
DWG# T-2007669

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T49	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

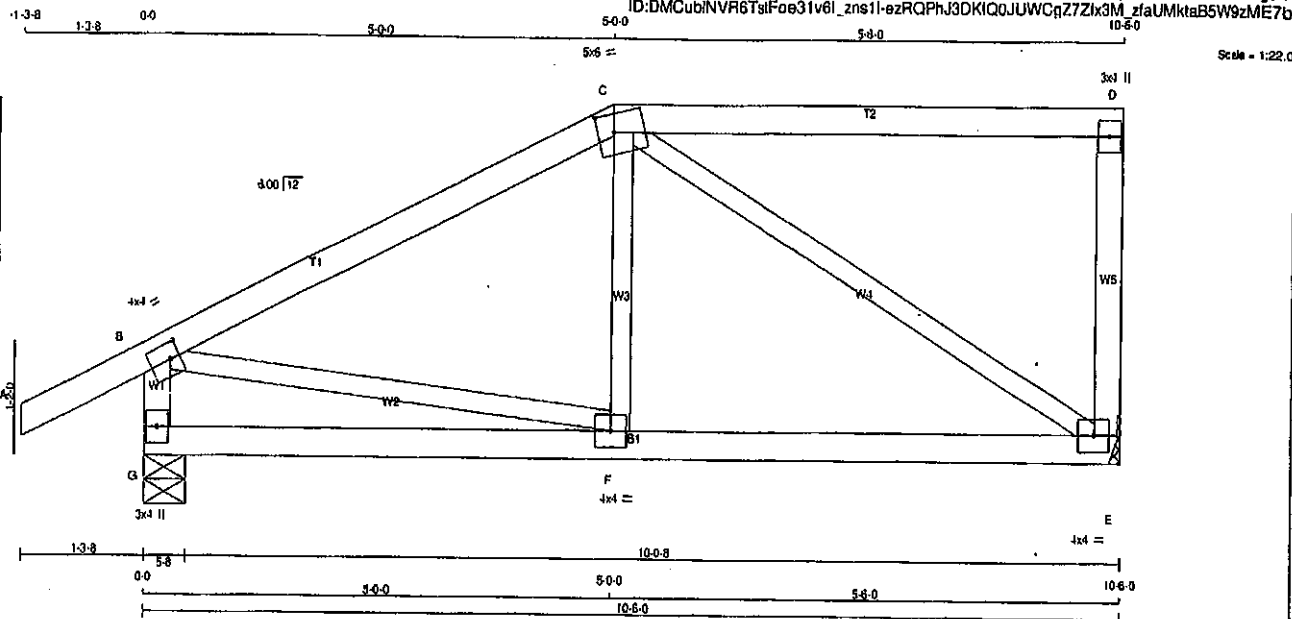

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
E - D	2x4	DRY	No.2
G - B	2x4	DRY	No.2
G - E	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

SPF

DRY: SEASONED LUMBER.

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMW-1	MT20	4.0	4.0	2.00 1.25
C	TTWW-m	MT20	5.0	6.0	2.25 2.00
D	TMW-p	MT20	3.0	4.0	
E	BMW-1	MT20	4.0	4.0	
F	BMWW-1	MT20	4.0	4.0	
G	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
E	579	0	579	0	0
G	703	0	703	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	409	289 0	0 0	0 0	0 0	141 0	0 0
G	495	338 0	0 0	0 0	0 0	157 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (LBS)	MAX. (PLF)	MEMB.	MAX. FORCE (LBS)
A-B	0	28	-91.8	F-C	0
B-C	-523	0	-91.8	C-E	-549
C-D	0	0	-91.8	E-F	0
D-E	-252	0	0.0		
E-F	-667	0	0.0		
G-F	0	0	-18.5		
F-E	0	468	-18.5		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.47 (C-D), BC=0.19 (E-F), WS=0.37 (C-E), SS=0.20 (C-D)

DOL LUMBER=1.00 NAIL=1.00 L3 BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (B) INPUT = 0.90
JSI METAL = 0.28 (B) INPUT = 1.00

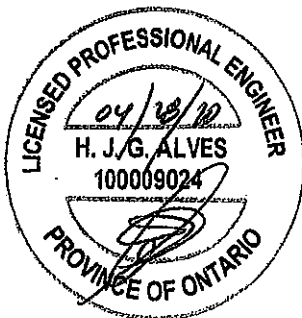


Structural component only
DWG# T-2007670

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	G50	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Tamarack Roof Truss, Burlington

Version 3.310 S Oct 29 2019 MTak Industries, Inc. Tue Apr 26 10:19:51 2020 Page 1
ID:DMCubINVR8TsFoe31v6I znsf1-eiv?rt6OD69qTihFid7MikFo7CC512EzRaiQozME7s

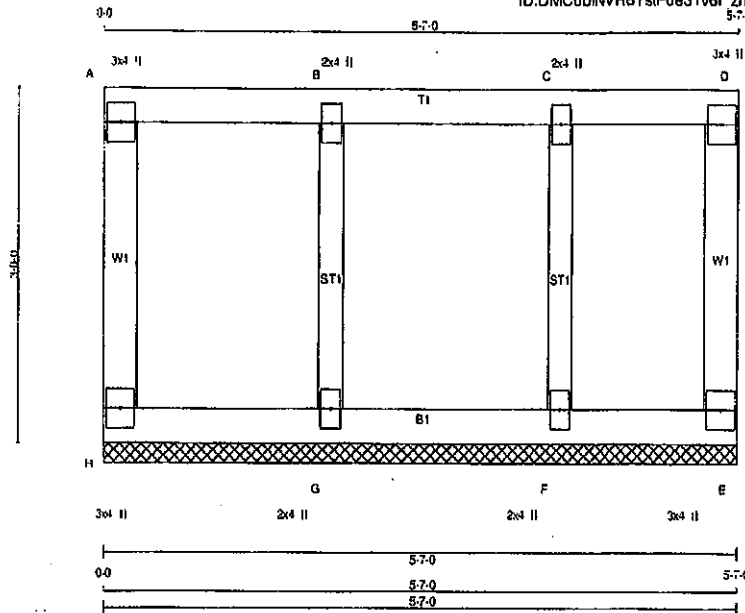

TOTAL WEIGHT = 22 lb
(M/F)

LUMBER

N. L. G. A. RULES			
CHORDS	SIZE		LUMBER
H - A	2x4	DRY	No.2
A - D	2x4	DRY	No.2
E - D	2x4	DRY	No.2
H - E	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
ALL GABLE WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2-0-0 OC.

DESCR.

SPF
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING
BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	UNBRACED LENGTH
FR-TO		FROM TO		FR-TO			
H-A	-101 0	0.0 0.0 0.03 (1)	7.81	G-B	-248 0	0.06 (1)	
A-B	-8 0	-114.3 -114.3 0.08 (1)	10.00	F-C	-209 0	0.05 (1)	
B-C	-8 0	-114.3 -114.3 0.08 (1)	10.00				
C-D	-8 0	-114.3 -114.3 0.08 (1)	10.00				
E-D	-80 0	0.0 0.0 0.03 (1)	7.81				
H-G	0 8	-18.5 -18.5 0.02 (4)	10.00				
G-F	0 8	-18.5 -18.5 0.02 (4)	10.00				
F-E	0 8	-18.5 -18.5 0.02 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6 PSF
	DL	= 15.0 PSF
BOT CH.	LL	= 0.0 PSF
	DL	= 7.4 PSF
TOTAL LOAD		= 48.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.08/1.00 (A-B:1), BC=0.02/1.00 (G-H:4), WB=0.08/1.00 (B-G:1), ST=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.17 (G) (INPUT = 0.90)
JSI METAL = 0.07 (G) (INPUT = 1.00)

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B	TMW+w	MT20	2.0	4.0		
C	TMW+w	MT20	2.0	4.0		
D	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		
F	BMW1+w	MT20	2.0	4.0		
G	BMW1+w	MT20	2.0	4.0		
H	BMV1+p	MT20	3.0	4.0		




Structural component only
DWG# T-2007656

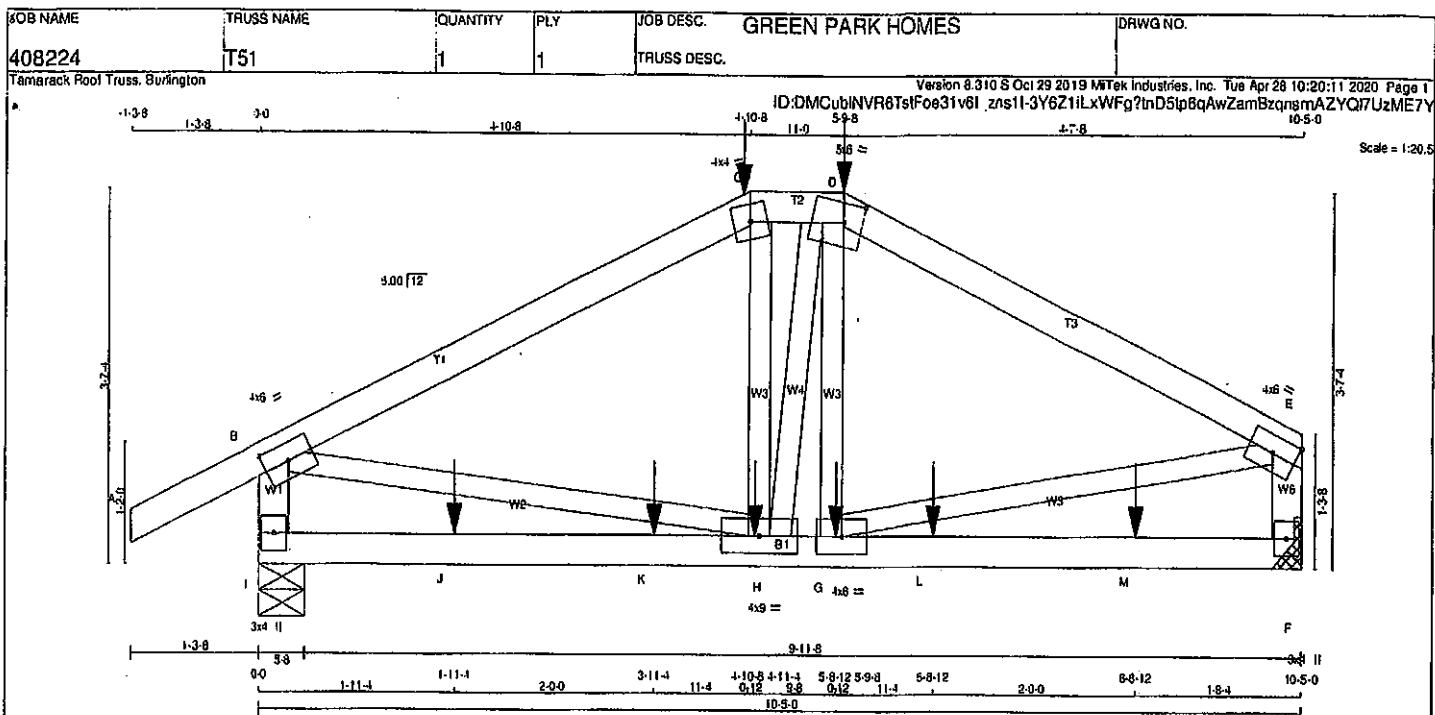

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR
A - C	2x4	DRY	No.2 SPF
C - D	2x4	DRY	No.2 SPF
D - E	2x4	DRY	No.2 SPF
E - F	2x4	DRY	No.2 SPF
F - G	2x4	DRY	No.2 SPF
G - H	2x4	DRY	No.2 SPF
H - I	2x4	DRY	No.2 SPF
I - J	2x4	DRY	No.2 SPF
J - K	2x4	DRY	No.2 SPF
K - L	2x4	DRY	No.2 SPF
L - M	2x4	DRY	No.2 SPF
M - N	2x4	DRY	No.2 SPF
N - O	2x4	DRY	No.2 SPF
O - P	2x4	DRY	No.2 SPF
P - Q	2x4	DRY	No.2 SPF
Q - R	2x4	DRY	No.2 SPF
R - S	2x4	DRY	No.2 SPF
S - T	2x4	DRY	No.2 SPF
T - U	2x4	DRY	No.2 SPF
U - V	2x4	DRY	No.2 SPF
V - W	2x4	DRY	No.2 SPF
W - X	2x4	DRY	No.2 SPF
X - Y	2x4	DRY	No.2 SPF
Y - Z	2x4	DRY	No.2 SPF
Z - AA	2x4	DRY	No.2 SPF
AA - AB	2x4	DRY	No.2 SPF
AB - AC	2x4	DRY	No.2 SPF
AC - AD	2x4	DRY	No.2 SPF
AD - AE	2x4	DRY	No.2 SPF
AE - AF	2x4	DRY	No.2 SPF
AF - AG	2x4	DRY	No.2 SPF
AG - AH	2x4	DRY	No.2 SPF
AH - AI	2x4	DRY	No.2 SPF
AI - AJ	2x4	DRY	No.2 SPF
AJ - AK	2x4	DRY	No.2 SPF
AK - AL	2x4	DRY	No.2 SPF
AL - AM	2x4	DRY	No.2 SPF
AM - AN	2x4	DRY	No.2 SPF
AN - AO	2x4	DRY	No.2 SPF
AO - AP	2x4	DRY	No.2 SPF
AP - AQ	2x4	DRY	No.2 SPF
AQ - AR	2x4	DRY	No.2 SPF
AR - AS	2x4	DRY	No.2 SPF
AS - AT	2x4	DRY	No.2 SPF
AT - AU	2x4	DRY	No.2 SPF
AU - AV	2x4	DRY	No.2 SPF
AV - AW	2x4	DRY	No.2 SPF
AW - AX	2x4	DRY	No.2 SPF
AX - AY	2x4	DRY	No.2 SPF
AY - AZ	2x4	DRY	No.2 SPF
AZ - BA	2x4	DRY	No.2 SPF
BA - BB	2x4	DRY	No.2 SPF
BB - BC	2x4	DRY	No.2 SPF
BC - BD	2x4	DRY	No.2 SPF
BD - BE	2x4	DRY	No.2 SPF
BE - BF	2x4	DRY	No.2 SPF
BF - BG	2x4	DRY	No.2 SPF
BG - BH	2x4	DRY	No.2 SPF
BH - BI	2x4	DRY	No.2 SPF
BI - BJ	2x4	DRY	No.2 SPF
BJ - BK	2x4	DRY	No.2 SPF
BK - BL	2x4	DRY	No.2 SPF
BL - BM	2x4	DRY	No.2 SPF
BM - BN	2x4	DRY	No.2 SPF
BN - BO	2x4	DRY	No.2 SPF
BO - BP	2x4	DRY	No.2 SPF
BP - BQ	2x4	DRY	No.2 SPF
BQ - BR	2x4	DRY	No.2 SPF
BR - BS	2x4	DRY	No.2 SPF
BS - BT	2x4	DRY	No.2 SPF
BT - BU	2x4	DRY	No.2 SPF
BU - BV	2x4	DRY	No.2 SPF
BV - BW	2x4	DRY	No.2 SPF
BW - BX	2x4	DRY	No.2 SPF
BX - BY	2x4	DRY	No.2 SPF
BY - BZ	2x4	DRY	No.2 SPF
BZ - CA	2x4	DRY	No.2 SPF
CA - CB	2x4	DRY	No.2 SPF
CB - CC	2x4	DRY	No.2 SPF
CC - CD	2x4	DRY	No.2 SPF
CD - CE	2x4	DRY	No.2 SPF
CE - CF	2x4	DRY	No.2 SPF
CF - CG	2x4	DRY	No.2 SPF
CG - CH	2x4	DRY	No.2 SPF
CH - CI	2x4	DRY	No.2 SPF
CI - CJ	2x4	DRY	No.2 SPF
CJ - CK	2x4	DRY	No.2 SPF
CK - CL	2x4	DRY	No.2 SPF
CL - CM	2x4	DRY	No.2 SPF
CM - CN	2x4	DRY	No.2 SPF
CN - CO	2x4	DRY	No.2 SPF
CO - CP	2x4	DRY	No.2 SPF
CP - CQ	2x4	DRY	No.2 SPF
CQ - CR	2x4	DRY	No.2 SPF
CR - CS	2x4	DRY	No.2 SPF
CS - CT	2x4	DRY	No.2 SPF
CT - CU	2x4	DRY	No.2 SPF
CU - CV	2x4	DRY	No.2 SPF
CV - CW	2x4	DRY	No.2 SPF
CW - CX	2x4	DRY	No.2 SPF
CX - CY	2x4	DRY	No.2 SPF
CY - CZ	2x4	DRY	No.2 SPF
CZ - DA	2x4	DRY	No.2 SPF
DA - DB	2x4	DRY	No.2 SPF
DB - DC	2x4	DRY	No.2 SPF
DC - DD	2x4	DRY	No.2 SPF
DD - DE	2x4	DRY	No.2 SPF
DE - DF	2x4	DRY	No.2 SPF
DF - DG	2x4	DRY	No.2 SPF
DG - DH	2x4	DRY	No.2 SPF
DH - DI	2x4	DRY	No.2 SPF
DI - DJ	2x4	DRY	No.2 SPF
DJ - DK	2x4	DRY	No.2 SPF
DK - DL	2x4	DRY	No.2 SPF
DL - DM	2x4	DRY	No.2 SPF
DM - DN	2x4	DRY	No.2 SPF
DN - DO	2x4	DRY	No.2 SPF
DO - DP	2x4	DRY	No.2 SPF
DP - DQ	2x4	DRY	No.2 SPF
DQ - DR	2x4	DRY	No.2 SPF
DR - DS	2x4	DRY	No.2 SPF
DS - DT	2x4	DRY	No.2 SPF
DT - DU	2x4	DRY	No.2 SPF
DU - DV	2x4	DRY	No.2 SPF
DV - DW	2x4	DRY	No.2 SPF
DW - DX	2x4	DRY	No.2 SPF
DX - DY	2x4	DRY	No.2 SPF
DY - DZ	2x4	DRY	No.2 SPF
DZ - EA	2x4	DRY	No.2 SPF
EA - EB	2x4	DRY	No.2 SPF
EB - EC	2x4	DRY	No.2 SPF
EC - ED	2x4	DRY	No.2 SPF
ED - EE	2x4	DRY	No.2 SPF
EE - EF	2x4	DRY	No.2 SPF
EF - EG	2x4	DRY	No.2 SPF
EG - EH	2x4	DRY	No.2 SPF
EH - EI	2x4	DRY	No.2 SPF
EI - EJ	2x4	DRY	No.2 SPF
EJ - EK	2x4	DRY	No.2 SPF
EK - EL	2x4	DRY	No.2 SPF
EL - EM	2x4	DRY	No.2 SPF
EM - EN	2x4	DRY	No.2 SPF
EN - EO	2x4	DRY	No.2 SPF
EO - EP	2x4	DRY	No.2 SPF
EP - EQ	2x4	DRY	No.2 SPF
EQ - ER	2x4	DRY	No.2 SPF
ER - ES	2x4	DRY	No.2 SPF
ES - ET	2x4	DRY	No.2 SPF
ET - EU	2x4	DRY	No.2 SPF
EU - EV	2x4	DRY	No.2 SPF
EV - EW	2x4	DRY	No.2 SPF
EW - EX	2x4	DRY	No.2 SPF
EX - EY	2x4	DRY	No.2 SPF
EY - EZ	2x4	DRY	No.2 SPF
EZ - FA	2x4	DRY	No.2 SPF
FA - FB	2x4	DRY	No.2 SPF
FB - FC	2x4	DRY	No.2 SPF
FC - FD	2x4	DRY	No.2 SPF
FD - FE	2x4	DRY	No.2 SPF
FE - FF	2x4	DRY	No.2 SPF
FF - FG	2x4	DRY	No.2 SPF
FG - FH	2x4	DRY	No.2 SPF
FH - FI	2x4	DRY	No.2 SPF
FI - FJ	2x4	DRY	No.2 SPF
FJ - FK	2x4	DRY	No.2 SPF
FK - FL	2x4	DRY	No.2 SPF
FL - FM	2x4	DRY	No.2 SPF
FM - FN	2x4	DRY	No.2 SPF
FN - FO	2x4	DRY	No.2 SPF
FO - FP	2x4	DRY	No.2 SPF
FP - FQ	2x4	DRY	No.2 SPF
FQ - FR	2x4	DRY	No.2 SPF
FR - FS	2x4	DRY	No.2 SPF
FS - FT	2x4	DRY	No.2 SPF
FT - FU	2x4	DRY	No.2 SPF
FU - FV	2x4	DRY	No.2 SPF
FV - FW	2x4	DRY	No.2 SPF
FW - FX	2x4	DRY	No.2 SPF
FX - FY	2x4	DRY	No.2 SPF
FY - FZ	2x4	DRY	No.2 SPF
FZ - GA	2x4	DRY	No.2 SPF
GA - GB	2x4	DRY	No.2 SPF
GB - GC	2x4	DRY	No.2 SPF
GC - GD	2x4	DRY	No.2 SPF
GD - GE	2x4	DRY	No.2 SPF
GE - GF	2x4	DRY	No.2 SPF
GF - GG	2x4	DRY	No.2 SPF
GG - GH	2x4	DRY	No.2 SPF
GH - GI	2x4	DRY	No.2 SPF
GI - GJ	2x4	DRY	No.2 SPF
GJ - GK	2x4	DRY	No.2 SPF
GK - GL	2x4	DRY	No.2 SPF
GL - GM	2x4	DRY	No.2 SPF
GM - GN	2x4	DRY	No.2 SPF
GN - GO	2x4	DRY	No.2 SPF
GO - GP	2x4	DRY	No.2 SPF
GP - GQ	2x4	DRY	No.2 SPF
GQ - GR	2x4	DRY	No.2 SPF
GR - GS	2x4	DRY	No.2 SPF
GS - GT	2x4	DRY	No.2 SPF
GT - GU	2x4	DRY	No.2 SPF
GU - GV	2x4	DRY	No.2 SPF
GV - GW	2x4	DRY	No.2 SPF
GW - GX	2x4	DRY	No.2 SPF
GX - GY	2x4	DRY	No.2 SPF
GY - GZ	2x4	DRY	No.2 SPF
GZ - HA	2x4	DRY	No.2 SPF
HA - HB	2x4	DRY	No.2 SPF
HB - HC	2x4	DRY	No.2 SPF
HC - HD	2x4	DRY	No.2 SPF
HD - HE	2x4	DRY	No.2 SPF
HE - HF	2x4	DRY	No.2 SPF
HF - HG	2x4	DRY	No.2 SPF
HG - HH	2x4	DRY	No.2 SPF
HH - HI	2x4	DRY	No.2 SPF
HI - HJ	2x4	DRY	No.2 SPF
HJ - HK	2x4	DRY	No.2 SPF
HK - HL	2x4	DRY	No.2 SPF
HL - HM	2x4	DRY	No.2 SPF
HM - HN	2x4	DRY	No.2 SPF
HN - HO	2x4	DRY	No.2 SPF
HO - HP	2x4	DRY	No.2 SPF
HP - HQ	2x4	DRY	No.2 SPF
HQ - HR	2x4	DRY	No.2 SPF
HR - HS	2x4	DRY	No.2 SPF
HS - HT	2x4	DRY	No.2 SPF
HT - HU	2x4	DRY	No.2 SPF
HU - HV	2x4	DRY	No.2 SPF
HV - HW	2x4	DRY	No.2 SPF
HW - HX	2x4	DRY	No.2 SPF
HX - HY	2x4	DRY	No.2 SPF
HY - HZ	2x4	DRY	No.2 SPF
HZ - IA	2x4	DRY	No.2 SPF
IA - IB	2x4	DRY	No.2 SPF
IB - IC	2x4	DRY	No.2 SPF
IC - ID	2x4	DRY	No.2 SPF
ID - IE	2x4	DRY	No.2 SPF
IE - IF	2x4	DRY	No.2 SPF
IF - IG	2x4	DRY	No.2 SPF
IG - IH	2x4	DRY	No.2 SPF
IH - II	2x4	DRY	No.2 SPF
II - IJ	2x4	DRY	No.2 SPF
IJ - IK	2x4	DRY	No.2 SPF
IK - IL	2x4	DRY	No.2 SPF
IL - IM	2x4	DRY	No.2 SPF
IM - IN	2x4	DRY	No.2 SPF
IN - IO	2x4	DRY	No.2 SPF
IO - IP	2x4	DRY	No.2 SPF
IP - IQ	2x4	DRY	No.2 SPF
IQ - IR	2x4	DRY	No.2 SPF
IR - IS	2x4	DRY	No.2 SPF
IS - IT	2x4	DRY	No.2 SPF
IT - IU	2x4	DRY	No.2 SPF
IU - IV	2x4	DRY	No.2 SPF
IV - IW	2x4	DRY	No.2 SPF
IW - IX	2x4	DRY	No.2 SPF
IX - IY	2x4	DRY	No.2 SPF
IY - IZ	2x4	DRY	No.2 SPF
IZ - JA	2x4	DRY	No.2 SPF
JA - JB	2x4	DRY	No.2 SPF
JB - JC	2x4	DRY	No.2 SPF
JC - JD	2x4	DRY	No.2 SPF
JD - JE	2x4	DRY	No.2 SPF
JE - JF	2x4	DRY	No.2 SPF
JF - JG	2x4	DRY	No.2 SPF
JG - JH	2x4	DRY	No.2 SPF
JH - JI	2x4	DRY	No.2 SPF
JI - JJ	2x4	DRY	No.2 SPF
JJ - JK	2x4	DRY	No.2 SPF
JK - JL	2x4	DRY	No.2 SPF
JL - JM	2x4	DRY	No.2 SPF
JM - JN	2x4	DRY	No.2 SPF
JN - JO	2x4	DRY	No.2 SPF
JO - JP	2x4	DRY	No.2 SPF
JP - JQ	2x4	DRY	No.2 SPF
JQ - JR	2x4	DRY	No.2 SPF
JR - JS	2x4	DRY	No.2 SPF
JS - JT	2x4	DRY	No.2 SPF
JT - JU	2x4	DRY	No.2 SPF
JU - JV	2x4	DRY	No.2 SPF
JV - JW	2x4	DRY	No.2 SPF
JW - JX	2x4	DRY	No.2 SPF
JX - JY	2x4	DRY	No.2 SPF
JY - JZ	2x4	DRY	No.2 SPF
JZ - KA	2x4	DRY	No.2 SPF
KA - KB	2x4	DRY	No.2 SPF
KB - KC	2x4	DRY	No.2 SPF
KC - KD	2x4	DRY	No.2 SPF
KD - KE	2x4	DRY	No.2 SPF
KE - KF	2x4	DRY	No.2 SPF
KF - KG	2x4	DRY	No.2 SPF
KG - KH	2x4	DRY	No.2 SPF
KH - KI	2x4	DRY	No.2 SPF
KI - KJ	2x4	DRY	No.2 SPF
KJ - KK	2x4	DRY	No.2 SPF
KK - KL	2x4	DRY	No.2 SPF
KL - KM	2x4	DRY	No.2 SPF
KM - KN	2x4	DRY	No.2 SPF
KN - KO	2x4	DRY	No.2 SPF
KO - KP	2x4	DRY	No.2 SPF
KP - KQ	2x4	DRY	No.2 SPF
KQ - KR	2x4	DRY	No.2 SPF
KR - KS	2x4	DRY	No.2 SPF
KS - KT	2x4	DRY	No.2 SPF
KT - KU	2x4	DRY	No.2 SPF
KU - KV	2x4	DRY	No.2 SPF
KV - KW	2x4	DRY	No.2 SPF
KW - KX	2x4	DRY	No.2 SPF
KX - KY	2x4	DRY	No.2 SPF
KY - KZ	2x4	DRY	No.2 SPF
KZ - LA	2x4	DRY	No.2 SPF
LA - LB	2x4	DRY	No.2 SPF
LB - LC	2x4	DRY	No.2 SPF
LC - LD	2x4	DRY	No.2 SPF
LD - LE	2x4	DRY	No.2 SPF
LE - LF	2x4	DRY	No.2 SPF
LF - LG	2x4	DRY	No.2 SPF
LG - LH	2x4	DRY	No.2 SPF
LH - LI	2x4	DRY	No.2 SPF
LI - LJ	2x4	DRY	No.2 SPF
LJ - LK	2x4	DRY	No.2 SPF
LK - LL	2x4	DRY	No.2 SPF
LL - LM	2x4	DRY	No.2 SPF
LM - LN	2x4	DRY	No.2 SPF
LN - LO	2x4	DRY	No.2 SPF
LO - LP	2x4	DRY	No.2 SPF
LP - LQ	2x4	DRY	No.2 SPF
LQ - LR	2x4	DRY	No.2 SPF
LR - LS	2x4	DRY	No.2 SPF
LS - LT	2x4	DRY	No.2 SPF
LT - LU	2x4	DRY	No.2 SPF
LU - LV	2x4	DRY	No.2 SPF
LV - LW	2x4	DRY	No.2 SPF
LW - LX	2x4	DRY	No.2 SPF
LX - LY	2x4	DRY	No.2 SPF
LY - LZ	2x4	DRY	No.2 SPF
LZ - MA	2x4	DRY	No.2 SPF
MA - MB	2x4	DRY	No.2 SPF
MB - MC	2x4	DRY	No.2 SPF
MC - MD	2x4	DRY	No.2 SPF
MD - ME	2x4	DRY	No.2 SPF
ME - MF	2x4	DRY	No.2 SPF
MF - MG	2x4	DRY	No.2 SPF
MG - MH	2x4	DRY	No.2 SPF
MH - MI	2x4	DRY	No.2 SPF
MI - MJ	2x4	DRY	No.2 SPF
MJ - MK	2x4	DRY	No.2 SPF
MK - ML	2x4	DRY	No.2 SPF
ML - MN	2x4	DRY	No.2 SPF
MN - MO	2x4	DRY	No.2 SPF
MO - MP	2x4	DRY	No.2 SPF
MP - MQ	2x4		

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T52	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:20:12 2020 Page 1	

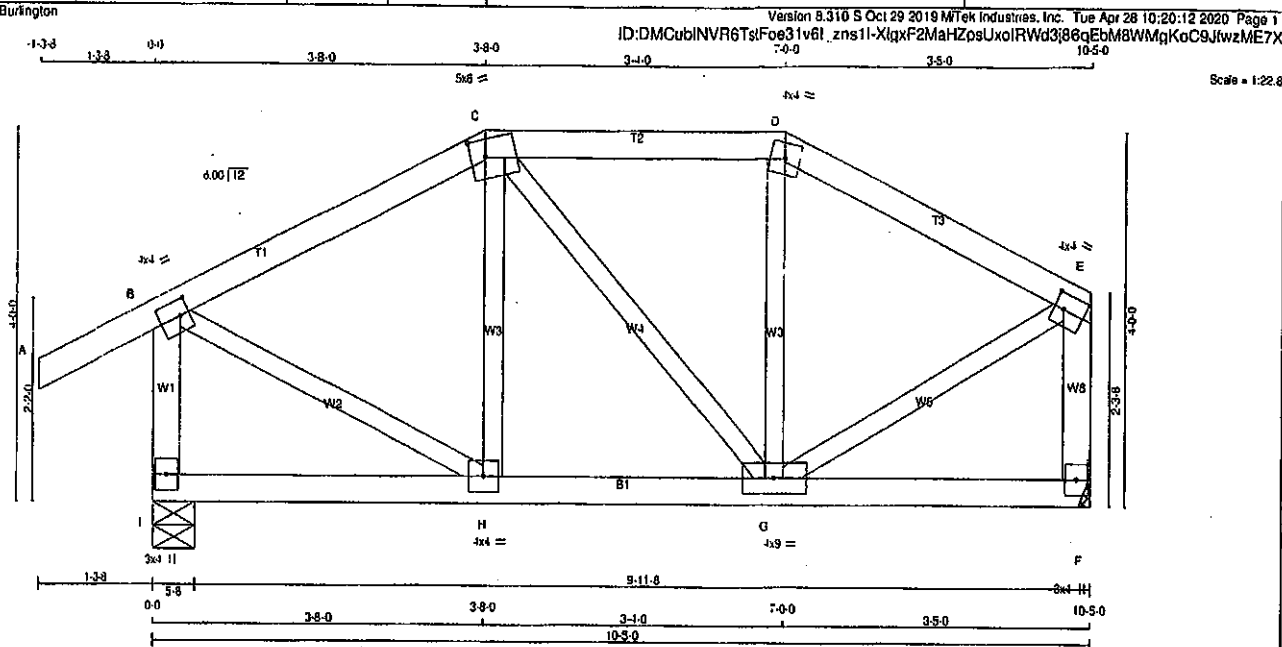

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
I - J	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMW-1	MT20	4.0	4.0	2.00	1.25
C	TTW-m	MT20	5.0	6.0	2.25	2.00
D	TTW-m	MT20	4.0	4.0		
E	TMW-1	MT20	4.0	4.0	2.00	1.25
F	BMV1+p	MT20	3.0	4.0		
G	BMWW-1	MT20	4.0	9.0		
H	BMWW-1	MT20	4.0	4.0		
I	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
JT	GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT RECD
	VERT	DOWN	BRG
I	699	0	5-8
F	574	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE
I	492	338	0	0
F	406	267	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)
FR-TO			
A-B	0 28	-91.8	10.00
B-C	-123 0	-91.8	8.25
C-D	-382 0	-91.8	8.25
D-E	-109 0	-91.8	8.25
E-F	-669 0	0.0	7.81
F-G	-548 0	0.0	7.81
G-H	0 0	-18.5	10.00
H-I	0 375	-18.5	10.00
I-J	0 0	-18.5	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPO 2011, TPO 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.18 (B-C:1), BC=0.09 (1.00 (B-H:1), WB=0.09 (1.00 (B-H:1), SS=0.12 (1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1687


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.65 (B) INPUT = 0.90
JSI METAL= 0.21 (B) INPUT = 1.00

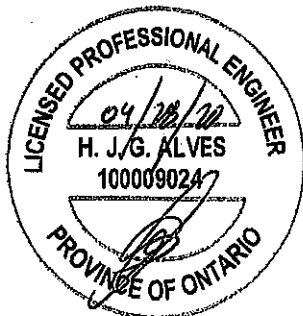


Structural component only
DWG# T-2007673



JOB NAME 408224	TRUSS NAME T54S	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Tue Apr 28 10:20:14 2020 Page 1
 ID:DMCubINVR6TstFoe31v6I zns1I-T7ohgkOqpA3ZkEygYxgXoZB2uPsf_43dGWecKpzME7V
 10-68

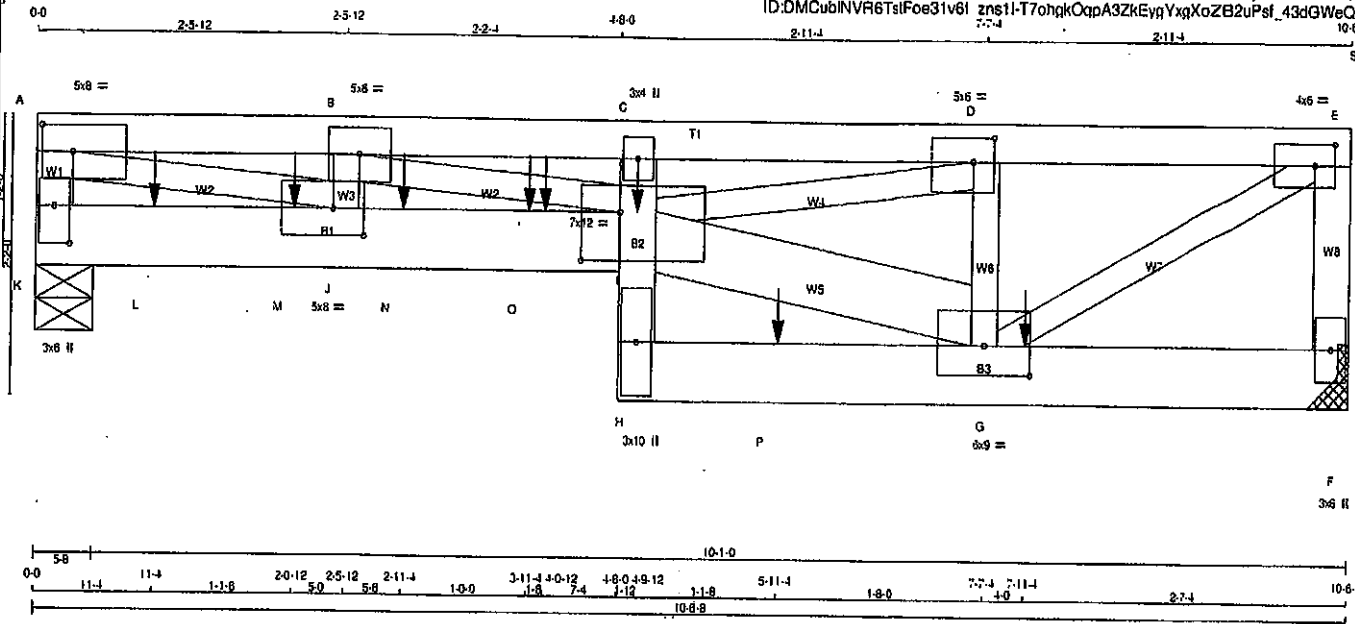


LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
K - A	2x4	DRY	No.2 SPF
A - E	2x4	DRY	No.2 SPF
F - E	2x4	DRY	No.2 SPF
K - I	2x6	DRY	No.2 SPF
H - C	2x4	DRY	No.2 SPF
H - F	2x6	DRY	No.2 SPF
ALL WEBS EXCEPT	2x3	DRY	No.2 SPF
I - G	2x6	DRY	No.2 SPF

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T54S	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:20:14 2020 Page 2
ID:DMCubINVR6TstFoe31v6I zns1I-T7ohgkOqpA3ZkEvgYqXoZB2uPsf 43dGWeQkpozME7V

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-I	MT20	5.0	8.0	2.50	3.00
B	TMVW-I	MT20	5.0	8.0		
C	TMV+p	MT20	3.0	4.0		
D	TMVW-I	MT20	5.0	6.0	2.25	2.00
E	TMVW-I	MT20	4.0	6.0	2.00	2.00
F	BMVt+p	MT20	3.0	6.0		
G	BMVWW-I	MT20	6.0	9.0	2.75	4.50
H	BMV+p	MT20	3.0	10.0		
I	BVMWW-I	MT20	7.0	12.0	4.50	3.75
J	BMVW-I	MT20	5.0	8.0	2.50	3.00
K	BMVt+p	MT20	3.0	6.0	3.50	1.50

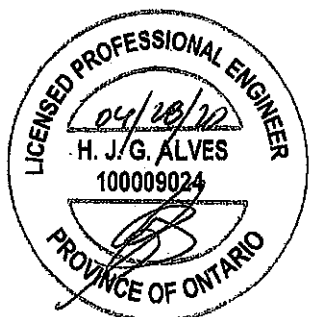

Structural component only
DWG# T-2007675


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	V1	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:00:14 2020 Page 1

ID:DMCubINVR6TsFoe3Iv6I zns1I-0hm5FSlyDNJdia79M8YvGLOsMVq3LML6VkvQG0zMFIV

21-0-7



Scale: 3/8\"/>

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
A - J	2x4	DRY	No.2
J - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

JT	FACTORED		MAXIMUM FACTORED		INPUT	REQD
	GROSS REACTION	DOWN	GROSS REACTION	UP		
	VERT	HORZ	DOWN	HORZ	BRG	BRG
A	128	0	128	0	21-0-7	11-11220-7
G	128	0	128	0	21-0-7	11-11220-7
I	330	0	330	0	21-0-7	11-11220-7
L	330	0	330	0	21-0-7	11-11220-7
K	433	0	433	0	21-0-7	11-11220-7
H	485	0	485	0	21-0-7	11-11220-7
M	485	0	485	0	21-0-7	11-11220-7

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST LCASE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
A	90	61	0	0	0	29	0
G	90	61	0	0	0	29	0
I	235	143	0	0	0	93	0
L	235	143	0	0	0	93	0
K	304	212	0	0	0	92	0
H	342	228	0	0	0	114	0
M	342	228	0	0	0	114	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, G, I, L, K, H, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FORCE (LBS)	MAX. CSI (LC)	MAX. CSI (LC)
FR-TO		FROM TO		FR-TO			
A-O	-23 2	-91.8 -91.8	0.04 (1)	I-E	-266 0	0.09 (1)	
O-B	0 33	-91.8 -91.8	0.21 (1)	L-C	-266 0	0.09 (1)	
B-C	-8 8	-91.8 -91.8	0.20 (1)	K-D	-377 0	0.13 (1)	
C-D	0 17	-91.8 -91.8	0.17 (1)	H-F	-393 0	0.06 (1)	
D-E	0 17	-91.8 -91.8	0.17 (1)	M-B	-393 0	0.06 (1)	
E-F	-6 8	-91.8 -91.8	0.20 (1)	N-O	-39 5	0.00 (1)	
F-G	0 33	-91.8 -91.8	0.21 (1)	P-Q	-39 5	0.00 (1)	
Q-G	-23 2	-91.8 -91.8	0.04 (1)				
A-N	-9 0	-18.5 -18.5	0.05 (1)				
N-M	-7 7	-18.5 -18.5	0.06 (4)				
M-L	-11 0	-18.5 -18.5	0.06 (4)				
L-K	-17 0	-18.5 -18.5	0.05 (4)				
K-J	-17 0	-18.5 -18.5	0.05 (4)				
J-I	-17 0	-18.5 -18.5	0.05 (4)				
I-H	-11 0	-18.5 -18.5	0.06 (4)				
H-P	-7 7	-18.5 -18.5	0.06 (4)				
P-G	-9 0	-18.5 -18.5	0.05 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 5.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.21 1.00 (B-O:1), BC=0.06 1.00 (L-M:4).
WB=0.13 1.00 (D-K:1), SSI=0.15 1.00 (D-E:1)

DDL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.51 (C) INPUT = 0.90
JSI METAL= 0.20 (F) INPUT = 1.00



Structural component only
DWG# T-2007616

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	ORWG NO.
408222	V2	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington


Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:00:15 2020 Page 1

ID:DMCubINVR6TsFoe31v6l zns11-UIKTTnJa hRUUKaLwZ38oYwtqu824qFkOeozTzMFIL

10-3-12

18-0-7

Scale = 1:29.4

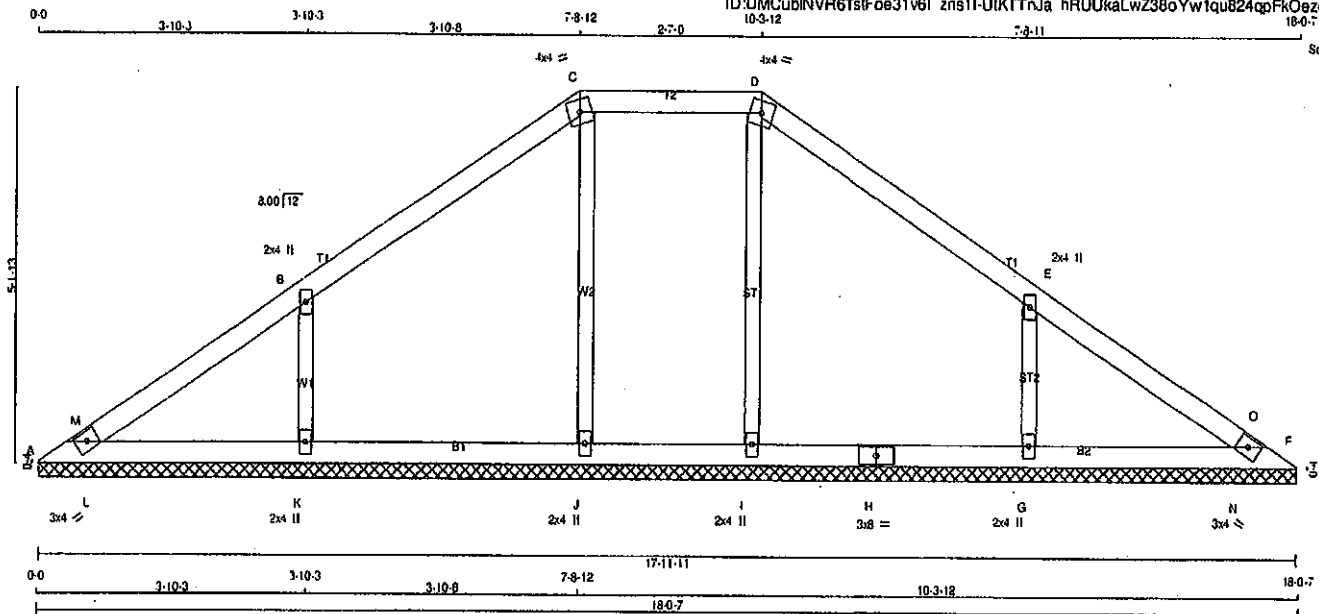

<u>LUMBER</u>					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER	DESCR	
A - C	2x4	DRY	No.2	SPF	
C - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
A - H	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
ALL WEBS		2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.					

PLATES (table in inches)	JT	TYPE	PLATES	W	LEN	Y	X
A	TBM1-h	MT20	3.0	4.0			
B	TTW-w	MT20	2.0	4.0			
C	TTW-m	MT20	4.0	4.0			
D	TTW-m	MT20	4.0	4.0			
E	TTW-w	MT20	2.0	4.0			
F	TBM1-h	MT20	3.0	4.0			
G, I, J, K							
G	BMW1-w	MT20	2.0	4.0			
H	BS-t	MT20	3.0	6.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
A	136	0	136	0	0	17-11-11	11-17-12-11
F	135	0	135	0	0	17-11-11	11-17-12-11
I	344	0	344	0	0	17-11-11	11-17-12-11
G	513	0	513	0	0	17-11-11	11-17-12-11
J	342	0	342	0	0	17-11-11	11-17-12-11
K	513	0	513	0	0	17-11-11	11-17-12-11

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED						
A	95	65	0	0	0	30	0
F	95	65	0	0	0	30	0
I	244	155	0	0	0	89	0
G	362	240	0	0	0	122	0
J	242	154	0	0	0	88	0
K	362	240	0	0	0	122	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, F, I, G, J, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX.	FACTORED	FACTORED		MEMB.	MAX.	FACTORED		
		FORCE	VERT. LOAD				FORCE		
		(LBS)	(PLF)	CSI (LC)			(LBS)	MAX	
FR-TO			FROM TO	UNBRACED LENGTH	FR-TO			CSI (LC)	
A-M	0	20	-91.8 -91.8	0.04 (1)	10.00	I-D	-292	0	
M-B	0	71	-91.8 -91.8	0.22 (1)	10.00	G-E	-408	0	
B-C	0	33	-91.8 -91.8	0.22 (1)	10.00	J-C	-291	0	
C-D	0	52	-91.8 -91.8	0.11 (1)	10.00	K-B	-408	0	
D-E	0	33	-91.8 -91.8	0.22 (1)	10.00	L-M	-71	4	
E-O	0	71	-91.8 -91.8	0.22 (1)	10.00	N-O	-89	5	
O-F	0	19	-91.8 -91.8	0.04 (1)	10.00				
A-L	-43	0	-18.5 -18.5	0.07 (1)	6.25				
L-K	-30	0	-18.5 -18.5	0.07 (1)	6.25				
K-J	-45	0	-18.5 -18.5	0.07 (4)	6.25				
J-I	-52	0	-18.5 -18.5	0.04 (4)	6.25				
I-H	-45	0	-18.5 -18.5	0.07 (4)	6.25				
H-G	-45	0	-18.5 -18.5	0.07 (4)	6.25				
G-N	-30	0	-18.5 -18.5	0.07 (1)	6.25				
N-F	-43	0	-18.5 -18.5	0.07 (1)	6.25				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	8.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCG 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.22(1.00 (E-O:1) , BC=0.07(1.00 (K-L:1) , WB=0.11 1.00 (D-I:1) , SSI=0.14(1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1667
	788	1987	1856

PLATE PLACEMENT TOL. = 0.260 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.61 (C) INPUT = 0.90)

JSI METAL= 0.21 (E) INPUT = 1.00)

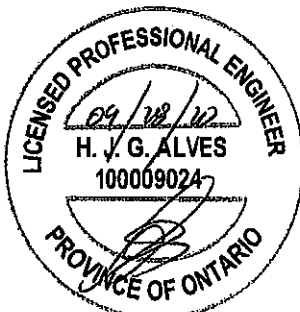


Structural component only
DWG# T-2007617

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	V3	1	1	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:00:16 2020 Page 1

ID:DMCubINVR6TstFoe31v6l_zns1l-y4trg7JCl_ZL8u9XTGaNLmTCiIVXpH4Oy2OWKvzMFIT

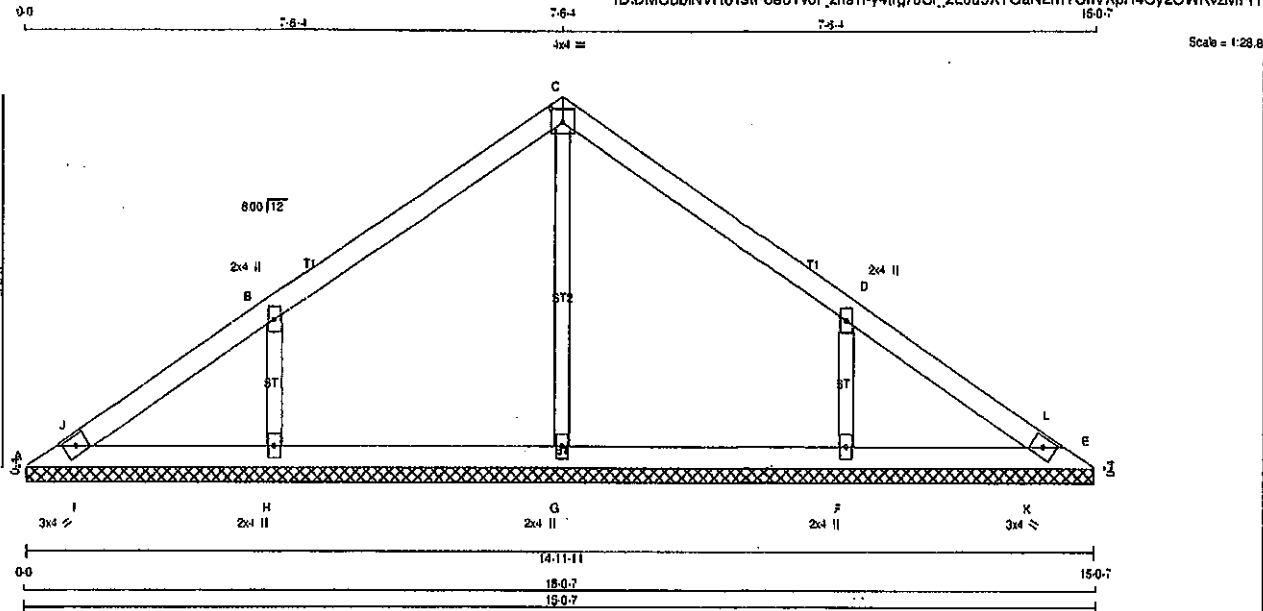

TOTAL WEIGHT = 43 lb (M)

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
A - E	2x4	DRY	No.2
ALL WEBS 2x3 DRY			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TBM1-h	MT20	3.0	4.0	
B	TMW-w	MT20	2.0	4.0	
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TMW-w	MT20	2.0	4.0	
E	TBM1-h	MT20	3.0	4.0	
F, G, H					
F	BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	BRG	BRG	BRG
A	134	0	134	0	0	14-11-11	14-11-11		
E	134	0	134	0	0	14-11-11	14-11-11		
G	381	0	381	0	0	14-11-11	14-11-11		
H	501	0	501	0	0	14-11-11	14-11-11		
F	501	0	501	0	0	14-11-11	14-11-11		

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
A	95	65 0	0 0	0 0	30 0	0 0
E	95	65 0	0 0	0 0	30 0	0 0
G	272	162 0	0 0	0 0	110 0	0 0
H	353	237 0	0 0	0 0	118 0	0 0
F	353	237 0	0 0	0 0	118 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS A, E, G, H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LC1)	MAX. (LC1)	MEMB.	FORCE (LBS)	MAX. (LC1)	MAX. (LC1)
FR-TO		FROM TO		FR-TO			
A-J	-20 4	-91.8 -91.8	0.04 (1)	G-C	-316 0	0.11 (1)	
J-B	0 38	-91.8 -91.8	0.22 (1)	H-B	-408 0	0.08 (1)	
B-C	-5 12	-91.8 -91.8	0.21 (1)	F-D	-408 0	0.08 (1)	
C-D	-5 12	-91.8 -91.8	0.21 (1)	I-J	-46 8	0.00 (1)	
D-L	0 36	-91.8 -91.8	0.22 (1)	K-L	-46 6	0.00 (1)	
L-E	-20 4	-91.8 -91.8	0.04 (1)				
A-I	-13 0	-18.5 -18.5	0.08 (1)				
I-H	-10 3	-18.5 -18.5	0.08 (4)				
H-G	-13 0	-18.5 -18.5	0.08 (4)				
G-F	-13 0	-18.5 -18.5	0.08 (4)				
F-K	-10 3	-18.5 -18.5	0.08 (4)				
K-E	-13 0	-18.5 -18.5	0.08 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.22/1.00 (B-J:1), BC=0.06/1.00 (G-H:4), WB=0.11/1.00 (C-G:1), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRP = 0.28 (D) (INPUT = 0.90)
JSI METAL = 0.21 (D) (INPUT = 1.00)

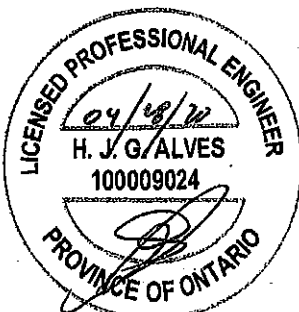


Structural component only
DWG# T-2007618

JOB NAME 408222	TRUSS NAME V4	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	-------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 9 Oct 2019 Mtek Industries, Inc. Tue Apr 28 11:37:42 2020 Page 1

ID:DMCubINVR6TslFoe31v8I_zns1I-NKeqA2eMCGf4MYH_q62VAKhU82Pb0QNm3/ZNsPzMD

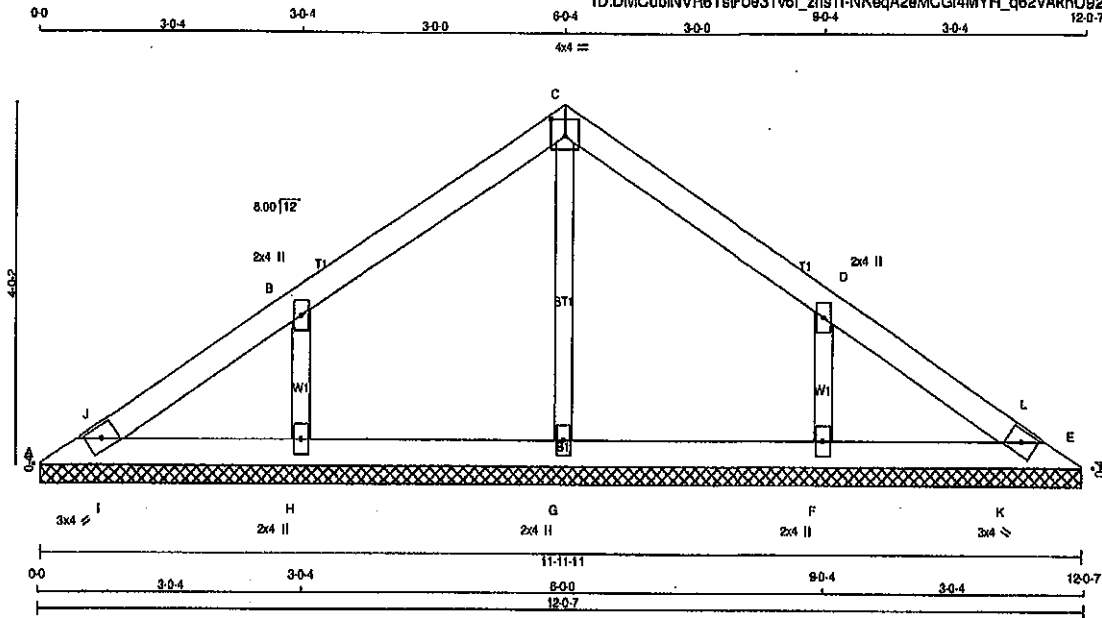

Scale = 1:23.7

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	No.2
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
A - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TBM1-h	MT20	3.0	4.0	
B	TBW+w	MT20	2.0	4.0	
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TBW+w	MT20	2.0	4.0	
E	TBM1-h	MT20	3.0	4.0	
F, G, H	BMW1+w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX		REQD BRG IN-SX	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
A	117	0	117	0	0	11-11-11	11-11-11
E	117	0	117	0	0	11-11-11	11-11-11
G	280	0	280	0	0	11-11-11	11-11-11
F	398	0	398	0	0	11-11-11	11-11-11
H	398	0	398	0	0	11-11-11	11-11-11

UNFACTORED REACTIONS							
JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	83	58 / 0	0 / 0	0 / 0	26 / 0	0 / 0	0 / 0
E	83	58 / 0	0 / 0	0 / 0	26 / 0	0 / 0	0 / 0
G	207	125 / 0	0 / 0	0 / 0	82 / 0	0 / 0	0 / 0
F	281	188 / 0	0 / 0	0 / 0	93 / 0	0 / 0	0 / 0
H	281	188 / 0	0 / 0	0 / 0	93 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, G, F, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-J	-8 / 5	-91.8 -91.8 0.03 (1)	10.00	G-C	-248 / 0	0.08 (1)	
J-B	0 / 38	-91.8 -91.8 0.13 (1)	10.00	F-D	-314 / 0	0.05 (1)	
B-C	0 / 12	-91.8 -91.8 0.13 (1)	10.00	H-B	-314 / 0	0.05 (1)	
C-D	0 / 12	-91.8 -91.8 0.13 (1)	10.00	I-J	-47 / 4	0.00 (1)	
D-L	0 / 38	-91.8 -91.8 0.13 (1)	10.00	K-L	-47 / 4	0.00 (1)	
L-E	-8 / 5	-91.8 -91.8 0.03 (1)	10.00				
A-I	-13 / 0	-18.5 -18.5 0.05 (1)	6.25				
I-H	-10 / 0	-18.5 -18.5 0.05 (1)	10.00				
H-G	-20 / 0	-18.5 -18.5 0.04 (4)	6.25				
G-F	-20 / 0	-18.5 -18.5 0.04 (4)	6.25				
F-K	-10 / 0	-18.5 -18.5 0.05 (1)	10.00				
K-E	-13 / 0	-18.5 -18.5 0.05 (1)	6.25				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.13/1.00 (B-J:1), BC=0.05/1.00 (A-I:1), WB=0.08/1.00 (C-G:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1887 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 6.0 Deg.


JSI GRIP= 0.22 (D) (INPUT = 0.90)
JSI METAL= 0.16 (B) (INPUT = 1.00)

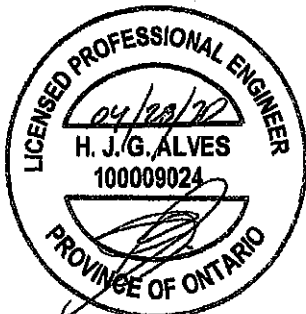

Structural component only
DWG# T-2007619

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	V5	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:17 2020 Page 1
ID:DMCubINVR6TstF0e31v6l_zns11-QGREITKqWlnCk2kk1_6olz7N9ip5YBYBi74ILzMFIS

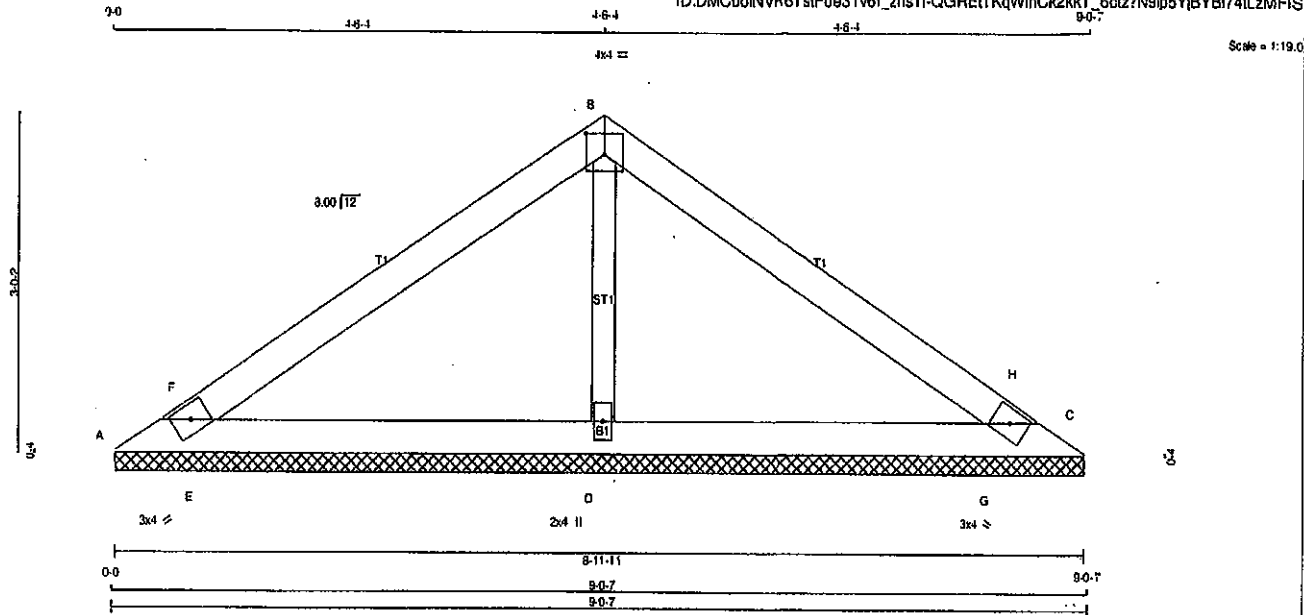

TOTAL WEIGHT = 23 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF	
B - C	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
A - B	h	MT20	3.0	4.0			
B - C	p	MT20	4.0	4.0	2.25	2.00	
C - B	h	MT20	3.0	4.0			
D - B	w	MT20	2.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ
A	49	0	49	0
C	49	0	49	0
D	893	0	893	0

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	34	22.0	0.0	0.0	0.0	0.0	12.0	0.0
C	34	22.0	0.0	0.0	0.0	0.0	12.0	0.0
D	631	415.0	0.0	0.0	0.0	0.0	216.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LG1 MAX CSI (LC)	MAX. UNBRAC FR-TO LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM	TO		D-B		
A-F	0 347	-91.8	-91.8	0.12 (1)	10.00	-698 0	0.12 (1)
F-B	0 341	-91.8	-91.8	0.23 (1)	10.00	E-F -225 0	0.00 (1)
B-H	0 341	-91.8	-91.8	0.23 (1)	10.00	G-H -225 0	0.00 (1)
H-C	0 347	-91.8	-91.8	0.12 (1)	10.00		
A-E	-321 0	-18.5	-18.5	0.16 (1)	6.25		
E-D	-290 0	-18.5	-18.5	0.17 (1)	6.25		
D-G	-290 0	-18.5	-18.5	0.17 (1)	6.25		
G-C	-321 0	-18.5	-18.5	0.16 (1)	6.25		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.23/1.00 (B-F:1), BC=0.17/1.00 (D-E:1), WB=0.12/1.00 (B-D:1), SS=0.12/1.00 (A-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.59 (B) (INPUT = 0.90)
JSI METAL = 0.20 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007620

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	PB1	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:00:02 2020 Page 1
 ID:DMCubINVR6TstFoe31v6I zns11-MN1ZkL9Q2hoKQk4rIKK5mpuqJfFXyLks7nrjzMFih

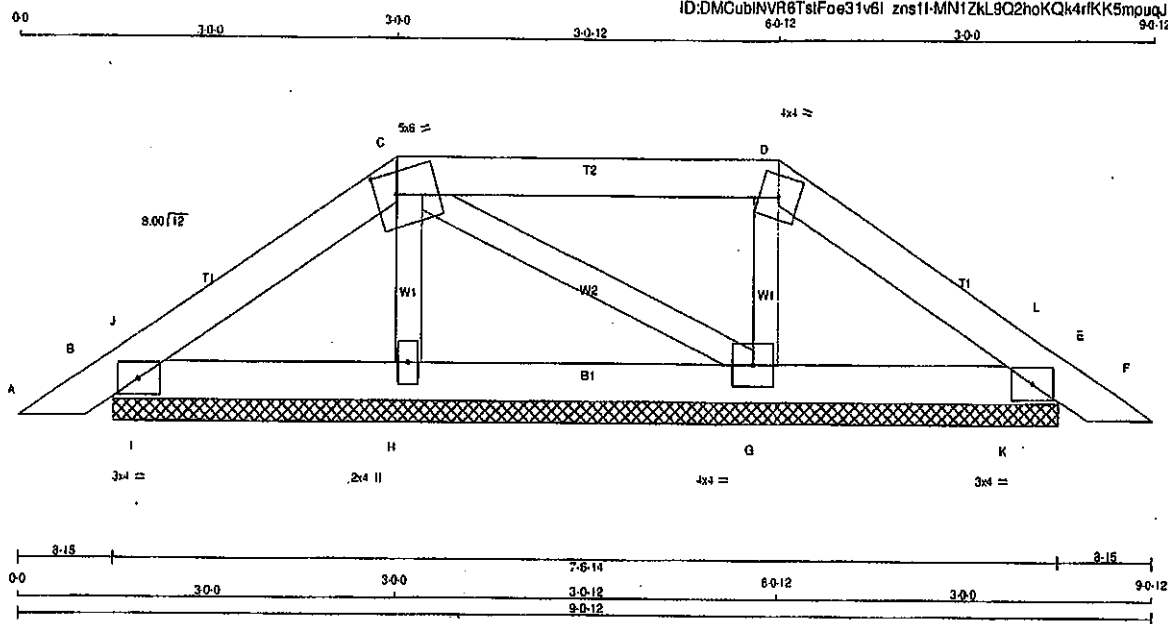

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	ORY	LUMBER	DESCR.
A - C	2x4	ORY	No.2	SPF
C - D	2x4	ORY	No.2	SPF
D - F	2x4	ORY	No.2	SPF
B - E	2x4	ORY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TM81-I	MT20	3.0	4.0		
C	TTWW-m	MT20	5.0	6.0	2.00	2.00
D	TTWW-m	MT20	4.0	4.0		
E	TM81-I	MT20	3.0	4.0		
G	BMWW1-I	MT20	4.0	4.0		
H	BMWW1-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
B	221	0	221	0
E	209	0	209	0
H	248	0	248	0
G	280	0	280	0

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
B	154	113	0	0	0	41	0
E	148	108	0	0	0	39	0
H	178	109	0	0	0	87	0
G	198	127	0	0	0	71	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED HORIZ. LOAD (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)
FR-TO							FR-TO		
A-B	0	15	-91.8	-91.8	0.03 (1)	10.00	H-C	-178	0
B-J	-93	0	-91.8	-91.8	0.01 (1)	6.25	C-G	-21	0
J-C	-75	0	-91.8	-91.8	0.05 (1)	6.25	G-D	-198	0
C-D	-30	0	-91.8	-91.8	0.15 (1)	6.25	I-J	-121	0
D-L	-54	0	-91.8	-91.8	0.05 (1)	8.25	K-L	-123	0
L-E	-41	0	-91.8	-91.8	0.01 (1)	6.25			
E-F	0	15	-91.8	-91.8	0.03 (1)	10.00			
B-I	0	60	-18.5	-18.5	0.06 (1)	10.00			
I-H	0	60	-18.5	-18.5	0.06 (1)	10.00			
H-G	0	48	-18.5	-18.5	0.03 (1)	10.00			
G-K	0	43	-18.5	-18.5	0.08 (1)	10.00			
K-E	0	43	-18.5	-18.5	0.08 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.15, 1.00 (C-D); 8C=0.08, 1.00 (B-I); 11B=0.09, 1.00 (D-G); 11S=0.11, 1.00 (C-D); 11

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 616 354 1667 788 1997 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) INPUT = 0.90

JSI METAL= 0.04 (B) INPUT = 1.00




Structural component only
 DWG# T-2007600

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408222	PB2	2	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 26 09:00:03 2020 Page 1

ID:DMCubINVR6TslFoe31v6l_zns1l-qabxxh92p?wB2ul2D2sKJ0Q7w31_GPEUzWkKN9zMF1g

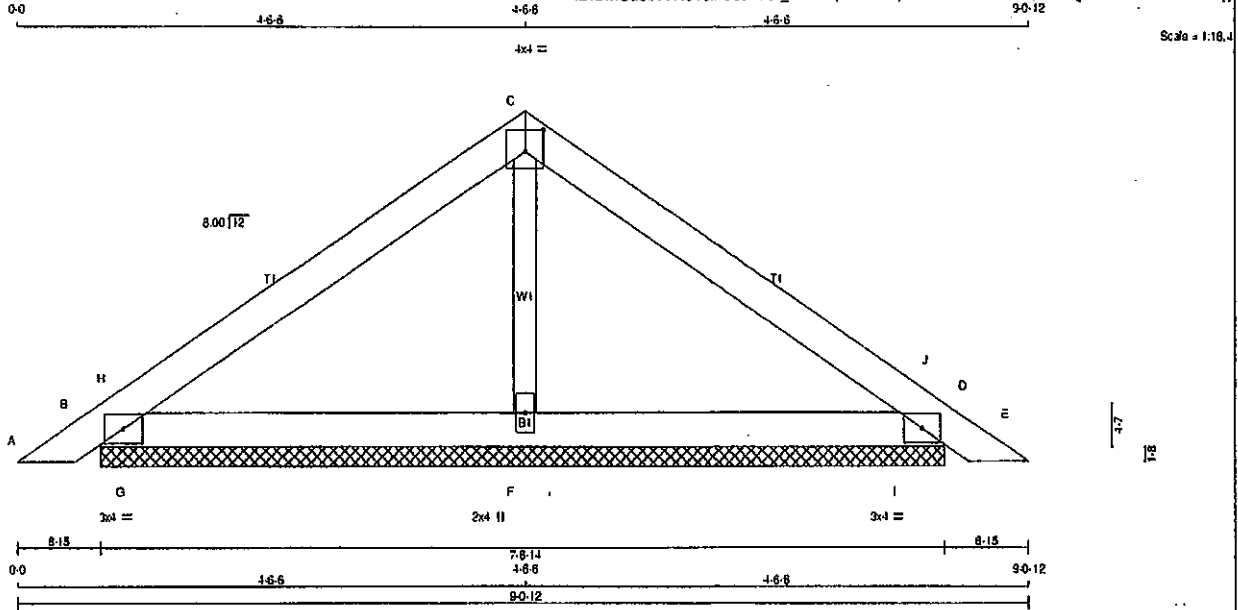

TOTAL WEIGHT = 2 X 23 = 46 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	SPF
C - E	2x4	DRY	SPF
B - D	2x4	DRY	SPF
ALL WEBS	2x3	DRY	SPF
DRY; SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TM81-I	MT20	3.0	4.0	
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TM81-I	MT20	3.0	4.0	
F	BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	BRG	IN-SX	IN-SX
B	318	0	318	0	0	7-6-14	7-6-14		
D	318	0	318	0	0	7-6-14	7-6-14		
F	320	0	320	0	0	7-6-14	7-6-14		

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	223	159 0	0 0	0 0	0 0	63 0	0 0	
D	223	159 0	0 0	0 0	0 0	63 0	0 0	
F	229	137 0	0 0	0 0	0 0	92 0	0 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. (PLF)	MAX. (LC)	MEMB.	FORCE (LBS)	MAX. (LC)	MAX. (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 15	-91.8	-91.8 0.03 (1)	10.00	F-C	-148 0	0.03 (1)
B-H	-31 0	-91.8	-91.8 0.07 (1)	8.25	G-H	-349 0	0.00 (1)
H-C	-135 0	-91.8	-91.8 0.16 (1)	8.25	I-J	-349 0	0.00 (1)
C-J	-135 0	-91.8	-91.8 0.16 (1)	8.25			
J-D	-31 0	-91.8	-91.8 0.07 (1)	8.25			
D-E	0 15	-91.8	-91.8 0.03 (1)	10.00			
B-G	0 105	-18.5	-18.5 0.15 (1)	10.00			
G-F	0 105	-18.5	-18.5 0.15 (1)	10.00			
F-I	0 105	-18.5	-18.5 0.15 (1)	10.00			
I-D	0 105	-18.5	-18.5 0.15 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.16 (C-J:1), BC=0.15 (F-I:1), WB=0.03 (C-F:1), SS=0.26 (I-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR SECTION
(PSI)	(PLI)
MAX MIN	MAX MIN
MT20	618 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.28 (D) (INPUT = 0.90)
JSI METAL = 0.07 (D) (INPUT = 1.00)




Structural component only
DWG# T-2007601

JOB NAME 408223	TRUSS NAME PB20	QUANTITY 4	PLV 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 \$ Oct 29 2019 Mitek Industries, Inc. Tue Apr 26 10:03:56 2020 Page 1

ID:DMCubINVR6TstFoe31v6I zns11-6 izPKYM7hrKOxBjFY7B9Jg2AAFEry9gNMkIPVzMEMr

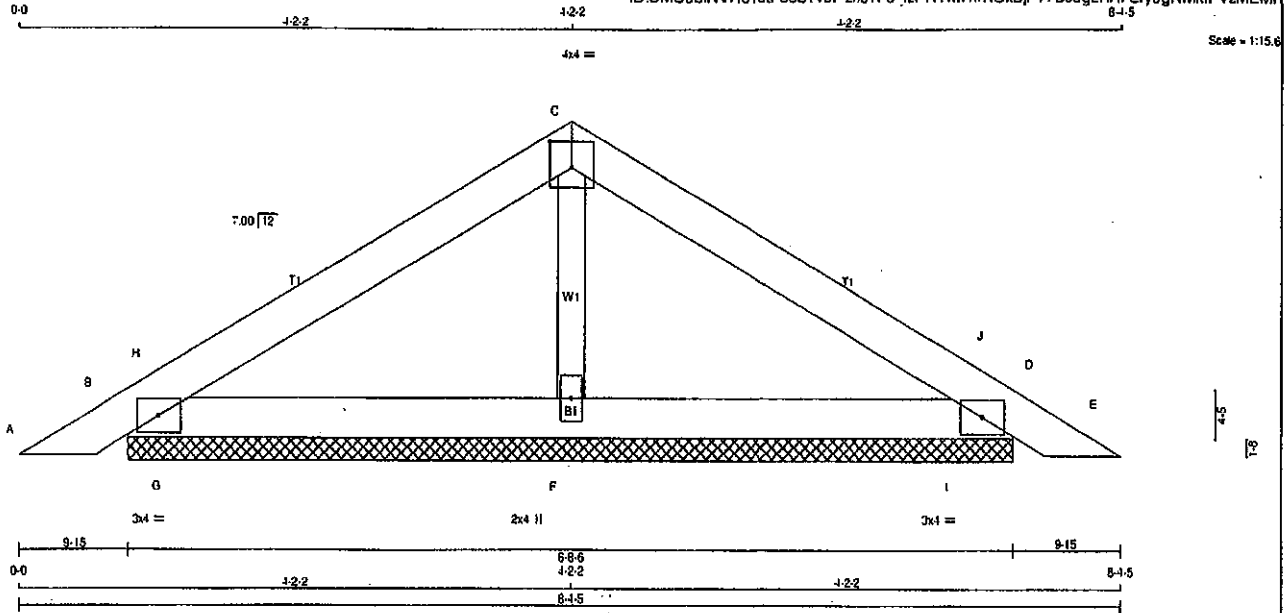

TOTAL WEIGHT = 4 X 20 = 80 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
B - D	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TM81-I	MT20	3.0	4.0	
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TM81-I	MT20	3.0	4.0	
F	BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
B	281	0	281	0	8-8-6	8-8-6
D	281	0	281	0	8-8-6	8-8-6
F	314	0	314	0	8-8-6	8-8-6

UNFACTORED REACTIONS

JT	COMBINED	MAX-MIN. COMPONENT REACTIONS					
		1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD
B	197	141	0	0	0	55	0
D	197	141	0	0	0	55	0
F	224	137	0	0	0	87	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 16	-91.8 -91.8	0.04 (1)	10.00	F-C	-159 0	0.02 (1)
B-H	-44 0	-91.8 -91.8	0.05 (1)	8.25	G-H	-250 0	0.00 (1)
H-C	-99 0	-91.8 -91.8	0.12 (1)	8.25	I-J	-250 0	0.00 (1)
C-J	-99 0	-91.8 -91.8	0.12 (1)	8.25			
J-D	-44 0	-91.8 -91.8	0.05 (1)	8.25			
D-E	0 16	-91.8 -91.8	0.04 (1)	10.00			
B-G	0 81	-18.5 -18.5	0.12 (1)	10.00			
G-F	0 81	-18.5 -18.5	0.12 (1)	10.00			
F-I	0 81	-18.5 -18.5	0.12 (1)	10.00			
I-D	0 81	-18.5 -18.5	0.12 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCG 2016, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (C-H:1), BC=0.12/1.00 (B-G:1), WB=0.02/1.00 (C-F:1), SS=0.18/1.00 (D-I:1)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1867	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 6.0 Deg.

JSI GRIP = 0.24 (D) (INPUT = 0.90)

JSI METAL = 0.06 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007627

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	PB21	1	1	TRUSS DESC.		

Tamrack Roof Truss, Burlington

Version 8.310 5 Oct 2019 MITek Industries, Inc. Tue Apr 28 10:03:57 2020 Page 1

ID:DMCubINVR6TstFoe31v6l zns11-aAGLcIZ u zB05vPFeQIXDDeZbFaPRpb0UDxxzMEMm

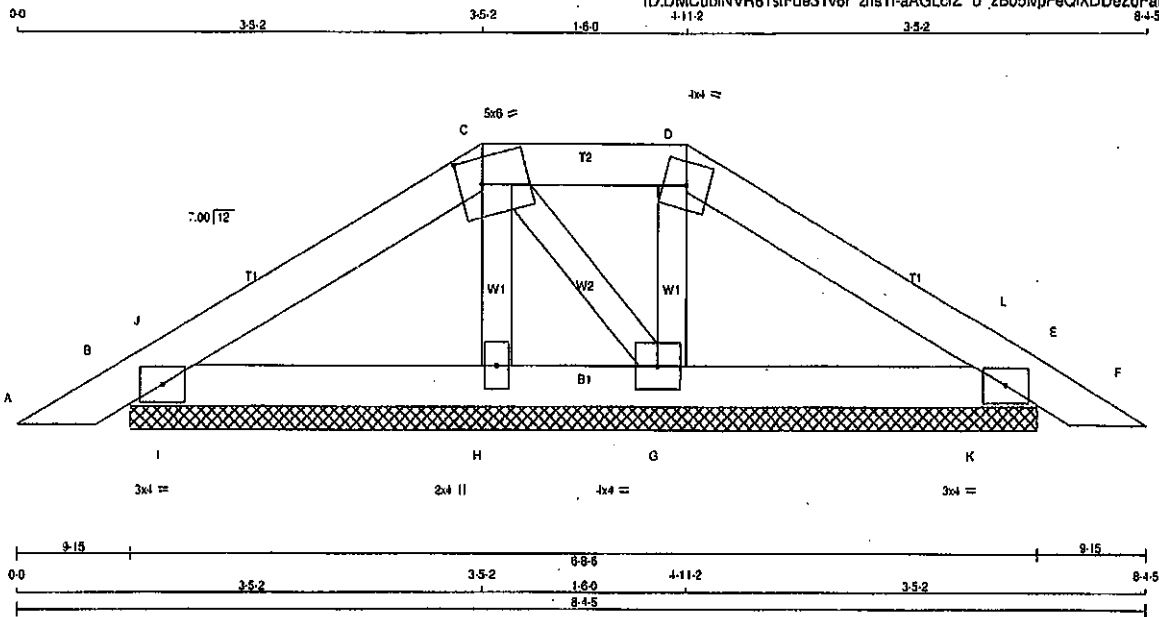

Scale = 1:15.2

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
B - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	HORZ	BRG	IN-SX	BRG
B	241	0	241	0	0	0	8-8-6	6-8-6	
E	228	0	228	0	0	0	8-8-6	6-8-6	
H	170	0	170	0	0	0	8-8-6	6-8-6	
G	238	0	238	0	0	0	8-8-6	6-8-6	

UNFACTORED REACTIONS

1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
B	189	121	0	0	0	48	0
E	180	114	0	0	0	46	0
H	122	74	0	0	0	48	0
G	168	111	0	0	0	57	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0 18	-91.8	-91.8	0.04 (1)	10.00	H-C	-107 0 0.02 (1)
B-J	-59 0	-91.8	-91.8	0.01 (1)	6.25	C-G	-36 0 0.01 (1)
J-C	-71 0	-91.8	-91.8	0.07 (1)	6.25	G-D	-147 0 0.02 (1)
C-D	-28 0	-91.8	-91.8	0.04 (1)	6.25	I-J	-139 0 0.00 (1)
D-L	-46 0	-91.8	-91.8	0.07 (1)	6.25	K-L	-141 0 0.00 (1)
L-E	-33 0	-91.8	-91.8	0.01 (1)	6.25		
E-F	0 18	-91.8	-91.8	0.04 (1)	10.00		
B-I	0 59	-18.5	-18.5	0.07 (1)	10.00		
I-H	0 59	-18.5	-18.5	0.07 (1)	10.00		
H-G	0 52	-18.5	-18.5	0.04 (1)	10.00		
G-K	0 38	-18.5	-18.5	0.07 (1)	10.00		
K-E	0 38	-18.5	-18.5	0.07 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012 : ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.07 (D-L:1), BC=0.07 (1.00 (B-I:1), WB=0.02 (1.00 (D-G:1), SS=0.11 (1.00 (E-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.19 (B) (INPUT = 0.90)
JSI METAL = 0.05 (D) (INPUT = 1.00)



Structural component only
DWG# T-2007628

JOB NAME 408223	TRUSS NAME PB22	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:03:58 2020 Page 1	

ID:DMCubINVR6TstFoe31v8l_zns11-2Mqjq7acIf52eFK5Nz9IEkmO2zyQJspZqgDmTNzMEMI
Scale = 1:15.2

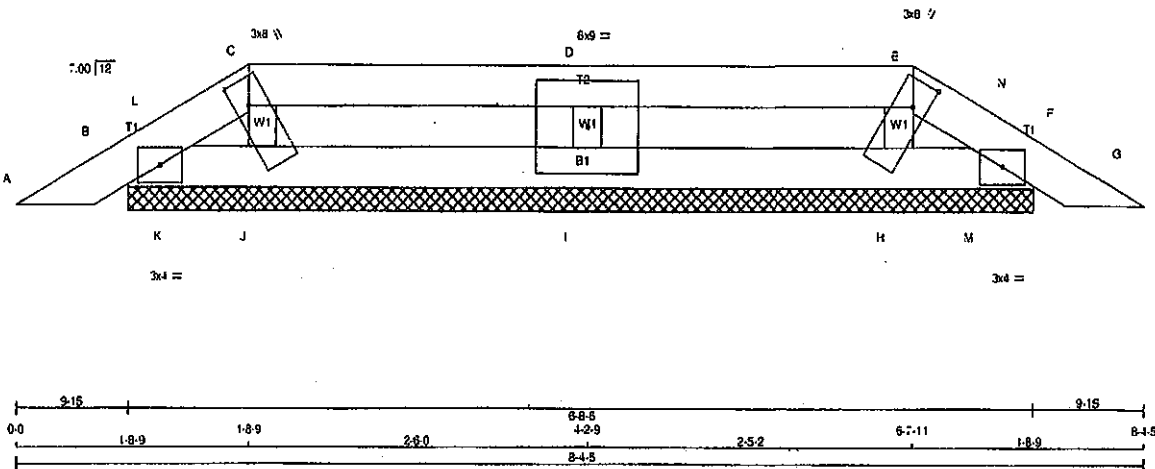

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - E	2x4	DRY No.2	SPF
E - G	2x4	DRY No.2	SPF
G - F	2x4	DRY No.2	SPF
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMB1-I	MT20	3.0	4.0	
C	D, E, H, I, J				
D	TTBW1-h	MT20	3.0	8.0	2.25 1.25
E	TMBMW1-I	MT20	8.0	9.0	
F	TTBW1-h	MT20	3.0	8.0	2.25 1.25
F	TMB1-I	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BRG
B	151	0	151	0	0	0	8-8-8	8-8-8	
F	152	0	152	0	0	0	8-8-8	8-8-8	
J	125	0	125	0	0	0	8-8-8	8-8-8	
H	120	0	120	0	0	0	8-8-8	8-8-8	
I	330	0	330	0	0	0	8-8-8	8-8-8	

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	DEAD	SOIL	DEAD	SOIL
B	105	83	0	0	0	0	0	21	0	0	0
F	105	83	0	0	0	0	0	22	0	0	0
J	90	49	0	0	0	0	0	41	0	0	0
H	86	47	0	0	0	0	0	39	0	0	0
I	232	158	0	0	0	0	0	74	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, F, J, H, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)	MAX	CSI (LC)
FR-TO		FROM	TO	FR-TO			
A-B	0 18	-91.8	-91.8 0.04 (1)	J-C	-95 0	0.01 (1)	
B-L	-53 0	-91.8	-91.8 0.04 (1)	H-E	-92 0	0.01 (1)	
L-C	-22 0	-91.8	-91.8 0.01 (1)	I-D	-282 0	0.04 (1)	
C-D	0 3	-91.8	-91.8 0.09 (1)	K-L	-1 12	0.00 (1)	
D-E	0 3	-91.8	-91.8 0.09 (1)	M-N	0 13	0.00 (1)	
E-N	-21 0	-91.8	-91.8 0.01 (1)				
N-F	-52 0	-91.8	-91.8 0.04 (1)				
F-G	0 16	-91.8	-91.8 0.04 (1)				
B-K	0 14	-18.5	-18.5 0.01 (1)				
K-J	0 14	-18.5	-18.5 0.02 (4)				
J-I	-3 0	-18.5	-18.5 0.02 (4)				
I-H	-3 0	-18.5	-18.5 0.02 (4)				
H-M	0 14	-18.5	-18.5 0.01 (4)				
M-F	0 14	-18.5	-18.5 0.01 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.09/1.00 (D-E-I), BC=0.02/1.00 (I-J-A),
WB=0.04/1.00 (D-I-I), SS=0.11/1.00 (C-D-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSH) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.13 (C) INPUT= 0.90
JSI METAL= 0.04 (C) INPUT= 1.00



Structural component only
DWG# T-2007629

JOB NAME 408223	TRUSS NAME P20	QUANTITY 17	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

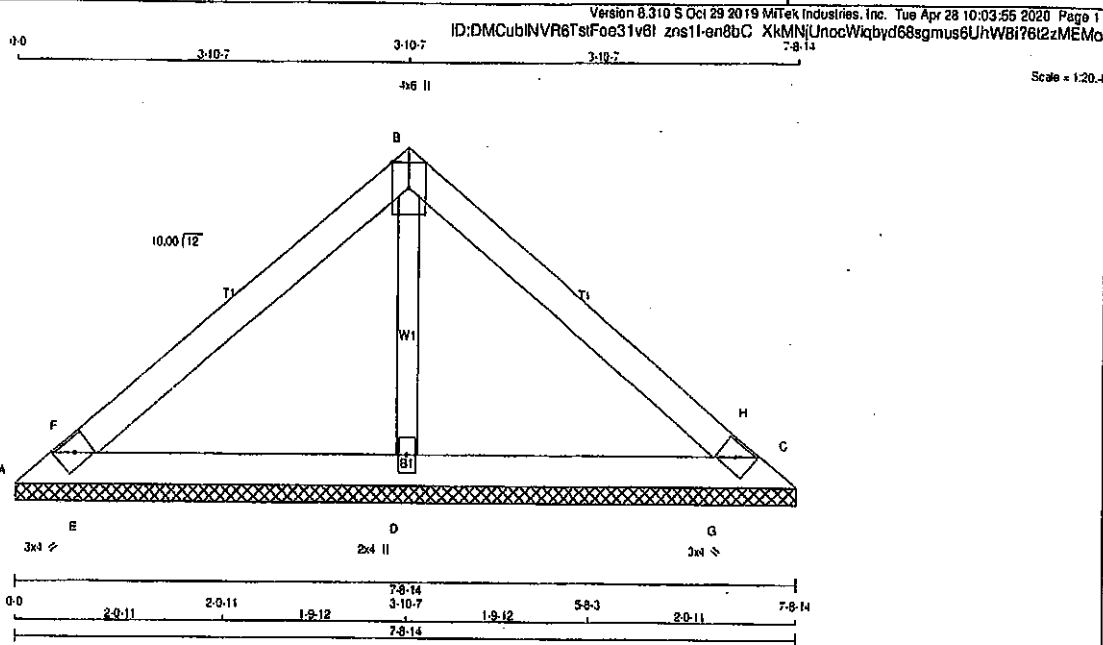

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
A - C	2x4	DRY	No.2

ALL WEBS 2x3 DRY
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A - TBMI-h	MT20	3.0	4.0		
B - TTW+p	MT20	4.0	6.0	Edge	
C - TBMI-h	MT20	3.0	4.0		
D - BMW1+w	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
A	60	0	60	0	7-8-14	7-8-14
C	60	0	60	0	7-8-14	7-8-14
D	733	0	733	0	7-8-14	7-8-14

UNFACTORED REACTIONS

JT	1ST CASE		MAX. MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	43	28.0	0.0	0.0	0.0	14.0	0.0
C	42	28.0	0.0	0.0	0.0	14.0	0.0
D	518	339.0	0.0	0.0	0.0	179.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS) A, C, D

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (L.C)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (L.C)	
FR-TO		FROM TO		FR-TO			
A-F	0 227	-91.8 -91.8 0.09 (1)	10.00	D-B	-558 0	0.10 (1)	
F-B	0 219	-91.8 -91.8 0.17 (1)	10.00	E-F	-199 0	0.00 (1)	
B-H	0 219	-91.8 -91.8 0.17 (1)	10.00	G-H	-199 0	0.00 (1)	
H-C	0 228	-91.8 -91.8 0.09 (1)	10.00				
A-E	-207 0	-18.5 -18.5 0.13 (1)	8.25				
E-D	-174 0	-18.5 -18.5 0.13 (1)	8.25				
D-G	-174 0	-18.5 -18.5 0.13 (1)	8.25				
G-C	-207 0	-18.5 -18.5 0.13 (1)	8.25				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BOBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.17 1.00 (B-F:1), BC=0.13/1.00 (D-E:1), WB=0.10/1.00 (B-D:1), SSI=0.11/1.00 (C-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PL)	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1657	788	1987 1858


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.29 (D) (INPUT = 0.90)
JSI METAL = 0.12 (D) (INPUT = 1.00)



Structural component only
DWG# T-2007626



DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9. NBCC 2010; NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

165 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOADS EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.05/1.00 (C-D:1), BC=0.02/1.00 (H-F:1), WB=0.03/1.00 (C-J:1), SS1=0.07/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.14 (E) (INPUT = 0.90)
JSI METAL = 0.10 (C) (INPUT = 1.00)




JOB NAME 408222	TRUSS NAME J1	QUANTITY 21	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	------------------	----------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 8 Oct 2019 Mitek Industries, Inc. Tue Apr 28 08:00:01 2020 Page 1

ID:DMCubINVR6TstFoe31v6I_zns11-u8TBW78oHNqUpbVI5dpsEbLZQFMuoV7BWCFEIHZMFH

Scale = 1:22.9

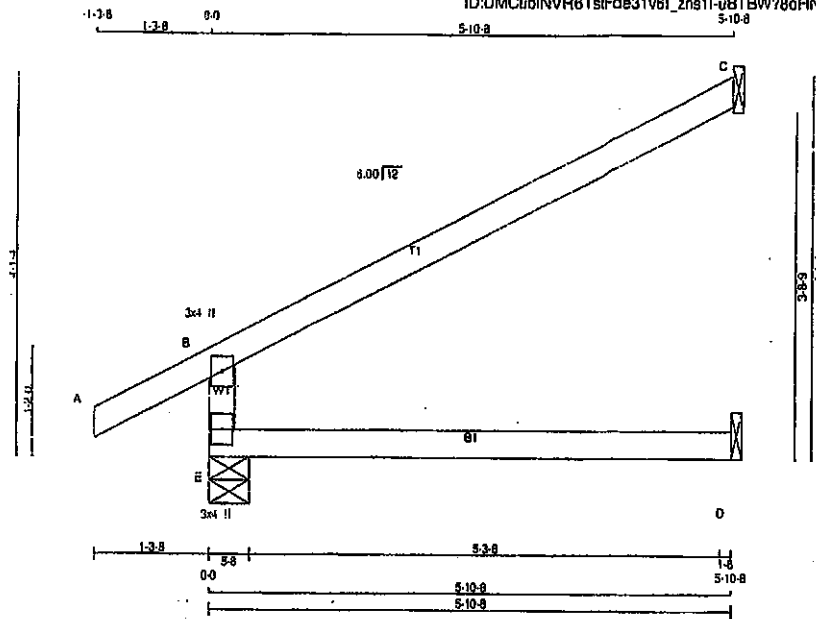

TOTAL WEIGHT = 21 X 17 = 353 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
8	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	RECORD
E	525	0	525	0	0	5-8	5-8
C	202	0	202	0	0	1-8	1-8
D	45	0	50	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
JT	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	389	257	0	0	0	111	0
C	139	113	0	0	0	26	0
D	38	0	0	0	0	36	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	UNBRACED LENGTH FR-TO
E-B	-161	0	0.0	0.0	0.13	14	7.81
A-B	0	28	-91.8	-91.8	0.12	11	10.00
B-C	-30	0	-91.8	-91.8	0.54	11	6.25
E-D	0	0	-18.5	-18.5	0.13	14	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CS: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (A-B:0), SB=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (PSI) SHEAR SECTION (PLI) (FLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.19 (E), INPUT = 0.90
JSI METAL = 0.13 (B), INPUT = 1.00




Structural component only
DWG# T-2007598

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	J2S	4	1	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 28 2019 MTEK Industries, Inc. Tue Apr 28 09:00:01 2020 Page 1

ID:DMCubINVR6TslFoe31vdl_zns1l-uBTBW78oHNgUpbVl5dpsEblhFOVoUrBWCfEIHZMFI

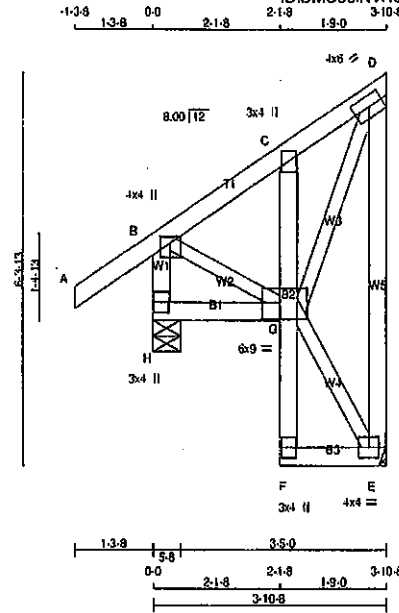

Scale = 1/4\"/>

TOTAL WEIGHT = 4 X 31 = 125 lb (M)

LUMBER	DESCR.
N. L. G. A. RULES	
CHORDS	
H - B 2x4 DRY No.2	SPF
A - D 2x4 DRY No.2	SPF
H - G 2x4 DRY No.2	SPF
F - C 2x4 DRY No.2	SPF
F - E 2x4 DRY No.2	SPF
ALL WEBS 2x3 DRY No.2	SPF
EXCEPT	
E - D 2x4 DRY No.2	SPF
DRY: SEASONED LUMBER.	

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE PLATES				
B TMVW+p MT20	4.0	4.0	1.25	2.00
C TMV+p MT20	3.0	4.0		
D TMVW-I MT20	4.0	6.0	2.00	2.75
E BMVW-I MT20	4.0	4.0		
F BMV+p MT20	3.0	4.0		
G BMVWVW-I MT20	6.0	9.0	3.25	3.50
H BMV-I+p MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
H	332	0	332	0
E	208	0	208	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

1ST LCASE	MAX.	MIN.	COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
H	232	168	0
E	145	95	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORIZ. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED HORIZ. LOAD (PLF)
FR-TO								
H-B	-311	0	0.0	0.0	0.03 (11)	7.81	B-G	0 97
A-B	0 35	-91.8	-91.8	0.14 (5)	10.00	E-D	-188	0 0.03 (1)
B-C	-96	0	-91.8	-91.8	0.05 (1)	6.25	G-E	-7
C-D	-105	0	-91.8	-91.8	0.05 (1)	6.25	G-D	0 204
H-G	0 0	-18.5	-18.5	0.03 (4)	10.00			
F-G	0 15	0.0	0.0	0.01 (1)	10.00			
G-C	-202	0	0.0	0.0	0.01 (1)	7.81		
F-E	0 4	-18.5	-18.5	0.01 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9. NBCG 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBCG 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

15% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.14 (1.00 (A-B:5) , 8C=0.03 (1.00 (G-H:4) , WB=0.08 (1.00 (D-E:1) , SS=0.09 (1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PL) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.22 (B) INPUT = 0.90
JSI METAL= 0.07 (C) INPUT = 1.00




Structural component only
DWG# T-2007599

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408223	J20S	2	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:03:51 2020 Page 1

ID:DMCubINVR6TsFoe31v6I_zns11-10v4McUDJ8C2AIIT_X7SGzA592PAg_xD41uHzMEMs

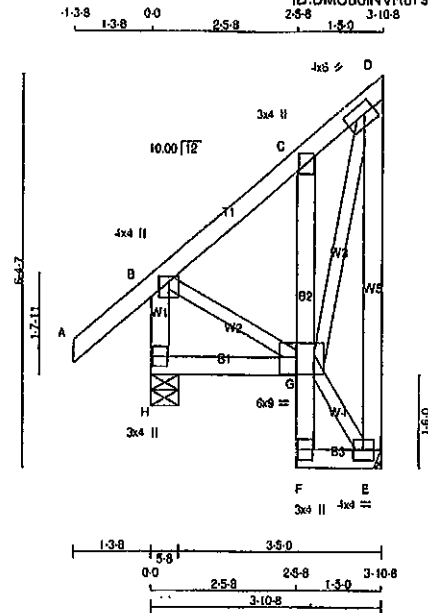

Scale = 1/32"

LUMBER			
N.L.G.A. RULES	CHORDS	SIZE	LUMBER
H - B	2x4	DRY	No.2
A - D	2x4	DRY	No.2
H - G	2x4	DRY	No.2
F - C	2x4	DRY	No.2
F - E	2x4	DRY	No.2
ALL WEBS EXCEPT E - D	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	3.0	1.00	2.00
C	TMV+p	MT20	3.0	4.0		
D	TMVW-i	MT20	4.0	6.0	2.00	2.00
E	BMVW-i	MT20	4.0	4.0		
F	BMV+p	MT20	3.0	4.0		
G	BMVW-i	MT20	6.0	9.0	3.25	3.50
H	BMV+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS	REACTION	DOWN	HORIZ	UP/LIFT	IN-SX	IN-SX	BRG
H	333	0	333	0	0	5-8			
E	208	0	208	0	0	MECHANICAL			

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	233	168	0	0	0	0	67	0
E	145	95	0	0	0	0	50	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLP)	LC1 MAX CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED MAX CS (LC)	
FR-TO		FROM TO		FR-TO			
H-B	-309 0	0.0	0.0 0.03 (1)	B-G	0 70	0.02 (1)	
A-B	0 41	-91.8	-91.8 0.14 (5)	E-D	-185 0	0.08 (1)	
B-C	-70 0	-91.8	-91.8 0.07 (1)	G-E	-13 0	0.00 (1)	
C-D	-92 0	-91.8	-91.8 0.06 (1)	G-D	0 216	0.05 (1)	
H-G	0 0	-18.5	-18.5 0.04 (4)	10.00			
F-G	0 12	0.0	0.0 0.02 (1)	10.00			
G-C	-216 0	0.0	0.0 0.02 (1)	7.81			
F-E	0 8	-18.5	-18.5 0.01 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24" IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9. NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.18")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.18")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.14/1.00 (A-B-5), BC=0.04/1.00 (G-H-4), WB=0.08/1.00 (D-E-1), SS=0.09/1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)		SHEAR		SECTION	
(PSI)		(PLI)		(PLI)	
MAX	MIN	MAX	MIN	MAX	MIN
MT20	818 354	1687	788	1987	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (8) (INPUT = 0.90)
JSI METAL = 0.08 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007623

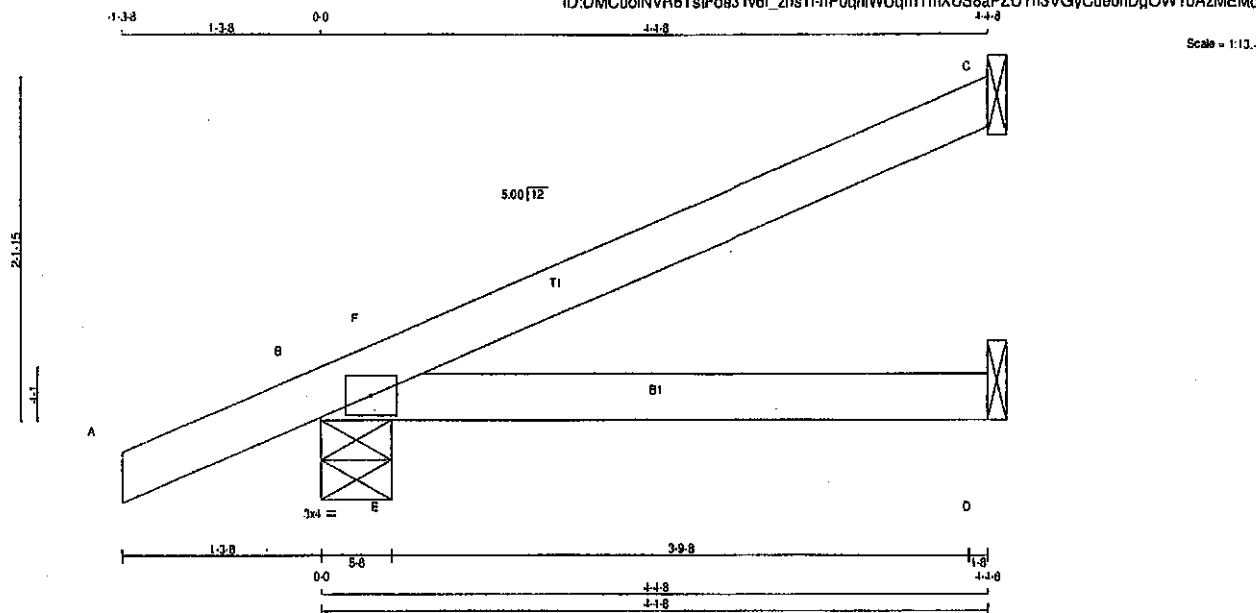

TOTAL WEIGHT = 4 X 12 = 49 lb

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER						
<u>BEARINGS</u>						
JC	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
C	175	0	175	0	0	1-8
B	365	0	365	0	0	5-8
D	67	0	67	0	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		MAX. MIN. COMPONENT REACTIONS					
JT	1ST LOASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
C	121	94 0	0 0	0 0	0 0	27 0	0 0
B	256	181 0	0 0	0 0	0 0	75 0	0 0
D	50	18 0	0 0	0 0	0 0	32 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSH(LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSH(LC)
FR-TO		FROM TO			FR-TO		
A-B	0 23	-91.8	-91.8	0.12 (1)	10.00		
B-F	-17 13	-91.8	-91.8	0.04 (4)	6.25	E-F	-235 7
F-C	1 2	-91.8	-91.8	0.23 (1)	10.00		0.00 (1)
B-E	0 0	-18.5	-18.5	0.16 (1)	10.00		
E-D	0 0	-18.5	-18.5	0.16 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD		39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L 360 (0.19")
CALCULATED VERT. DEFL.(LL) = L 999 (0.02")
ALLOWABLE DEFL.(TL) = L 360 (0.19")
CALCULATED VERT. DEFL.(TL) = L 999 (0.05")

CSI: TC=0.23/1.00 (C-F:1), BC=0.16/1.00 (D-E:1),
WB=0.00/1.00 (E-F:1), SSF=0.19/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)	(PLI)	(PLI)	(PLI)	(PLI)	(PLI)
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1867	788	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.26 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007624

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	J22	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 3.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:03:54 2020 Page 1

ID:DMCubINVR6TstFoe3tv6I zns11-AbaD eX6b3bd9e1K874j4ubgIMZPN21Nv2FYKczMEMp

Scale = 1:27.0

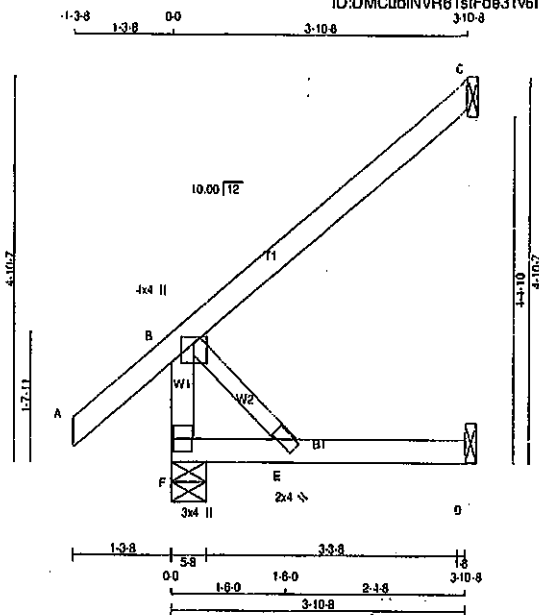

TOTAL WEIGHT = 3 X 15 = 45 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DRY
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W.	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
E	BMW+w	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
F	341	0	341	0	0	5-8	5-8
C	178	0	178	0	0	1-8	1-8
D	36	0	40	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97781H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST CASE	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
JT	COMBINED					
F	239	170	0	0	0	0
C	122	99	0	0	0	0
D	29	0	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		WEBS	
MEMB.	FORCE (LBS)	MEMB.	FORCE (LBS)
FR-TO	FROM TO	FR-TO	FROM TO
F-B	-305 0	B-E	0 0
A-B	0 -41		
B-C	0 0		
F-E	0 0		
E-D	0 0		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2019, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

65% OF 31.3 P.S.F. (S.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.18")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.23/1.00 (B-C:1), BC=0.08/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (B) (INPUT = 0.90)
JSI METAL = 0.08 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007625

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	J40	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:52 2020 Page 1
ID:DMCubINVR6TstF0a31v6t, zns11-6uTN2C71 PHh5sGSQJGMvwmHM, XXOqKBNC5JFy4zME7r

Scale = 1:20.5

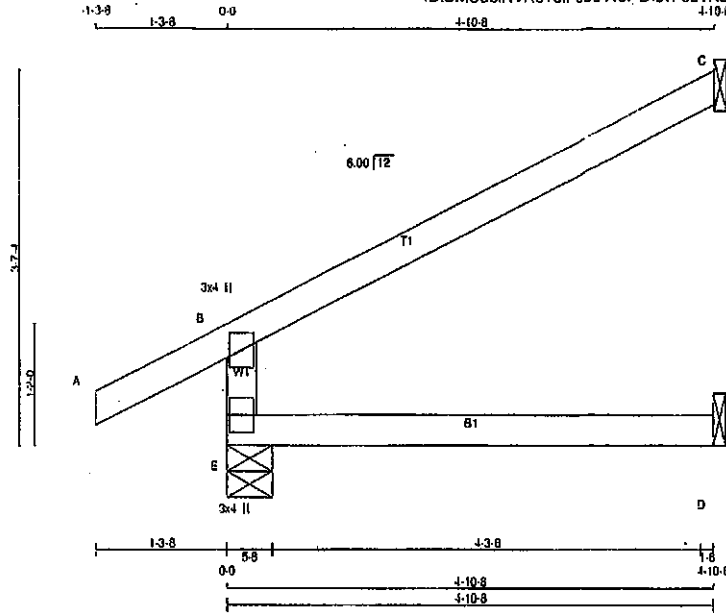

TOTAL WEIGHT = 2 X 14 = 28 lb [M]

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING DESIGNER							
BEARINGS							
	FACTORED		MAXIMUM FACTORED		INPUT	REQRD	
	GROSS REACTION		GROSS REACTION		BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	456	0	456	0	0	5-8	5-8
C	168	0	168	0	0	1-8	1-8
D	38	0	42	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL 697791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	320	225 0	0 0	0 0	0 0	95 0	0 0
C	118	94 0	0 0	0 0	0 0	22 0	0 0
D	30	0 0	0 0	0 0	0 0	30 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FORCE (LBS)	FACTORED MAX. CS (LC)
FR-TO		FROM TO			FR-TO		
E-B	-404 0	0.0	0.0	0.08 (4)	7.81		
A-B	0 28	-91.8	-91.8	0.12 (1)	10.00		
B-C	-25 0	-91.8	-91.8	0.37 (1)	6.25		
E-D	0 0	-18.5	-18.5	0.09 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/989 (0.02")

CSK TC=0.37 1.00 (B-C:1), BC=0.09/1.00 (D-E:1),
WB=0.00/1.00 (max:0), SSL=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788
	1967	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (E) (INPUT = 0.90)
JSI METAL= 0.11 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007657

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	J41	5	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:54 2020 Page 1			
		ID:DMCubINV8Ts1Foe31v6I zns11-3Hb7Tu8HW1XPKAQqNkQj.LMmiLemlEhgPom1zzME7p			
		Scale = 1:17.8			

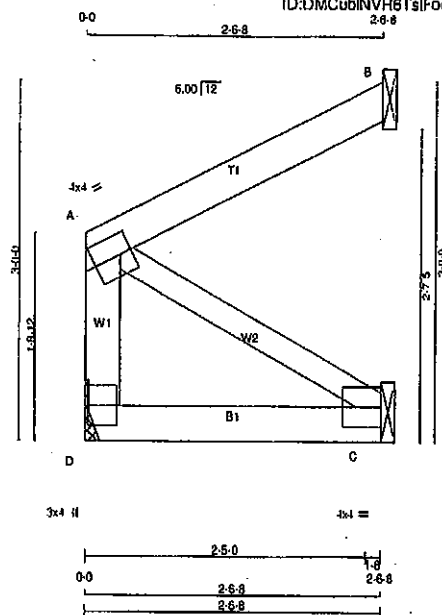

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
D - A	2x4	DRY	No.2
A - B	2x4	DRY	No.2
D - C	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		RECORD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
D	139	0	139	0	0	MECHANICAL		
B	117	0	117	0	0	1-8	1-8	
C	23	0	25	0	0	1-8	1-8	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS

JT	COMBINED	MAX. MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	98	65 0	0 0	0 0	0 0	33 0	0 0
B	80	65 0	0 0	0 0	0 0	15 0	0 0
C	18	0 0	0 0	0 0	0 0	18 0	0 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM TO		FR-TO			
D-A	117 0	0.0 0.0 0.01 (1)	7.81	A-C	0 0	0.00 (1)	
A-B	0 0	-91.8 -91.8 0.10 (1)	10.00				
D-C	0 0	-18.5 -18.5 0.03 (4)	10.00				

TOTAL WEIGHT = 5 X 10 = 49 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.10/1.00 (A-B:1) , BC=0.03/1.00 (C-D:4) ,
WB=0.00/1.00 (A-C:1) , SS=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.07 (A) INPUT = 0.90
JSI METAL= 0.02 (A) INPUT = 1.00



Structural component only
DWG# T-2007658


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	J42	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:55 2020 Page 1

ID:DMCubINVR6TstFoe31v61 zns1I-X18WgE9vHKIGyK71xSq3XYumIX 1hxqu3YvZPzME7c

Scale = 1:22.9

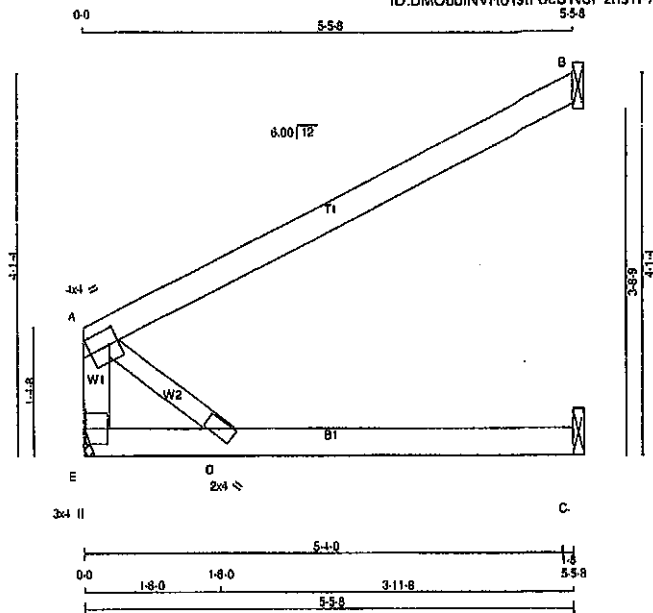

TOTAL WEIGHT = 2 X 16 = 31 lb (M/F)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	No.2	LUMBER	DESCR.
E - A	2x4	DRY	No.2				SPF
A - B	2x4	DRY	No.2				SPF
E - C	2x4	DRY	No.2				SPF
ALL WEBS	2x3	DRY	No.2				SPF
DRY: SEASONED LUMBER.							

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
A - TMVW-1	MT20	4.0	4.0	2.00	1.25		
D - BMW-w	MT20	2.0	4.0				
E - BMV1-p	MT20	3.0	4.0				

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	GROSS REACTION	MAXIMUM FACTORED	INPUT	REQD
	VERT	HORZ	DOWN	HORZ	UPLIFT
JT	301	0	301	0	0
E	250	0	250	0	0
B	50	0	57	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	213	140	0	0	0	73	0
E	172	140	0	0	0	33	0
B	40	0	0	0	0	40	0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	VERT. LOAD	FACTORED	VERT. LOAD	MAX. CSI (LC)	UNBRAC	MEMB.	MAX. FACTORED	VERT. LOAD	FACTORED	VERT. LOAD	MAX. CSI (LC)
MEMB.	FORCE (LBS)	FROM TO	FROM TO	FROM TO	FROM TO	FROM TO	FROM TO	FORCE (LBS)	FROM TO	FROM TO	FROM TO	FROM TO
E-A	250	0	0.0	0.0	0.03 (1)	7.81	A-D	0	0	0.00 (1)		
A-B	0	0	-91.8	-91.8	0.46 (1)	10.00						
E-D	0	0	-18.5	-18.5	0.13 (4)	10.00						
D-C	0	0	-18.5	-18.5	0.16 (4)	10.00						

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSF: TC=0.18/1.00 (A-B:1), BC=0.16/1.00 (C-D:4), WB=0.00/1.00 (A-C:1), SS=0.17/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.15 (A) (INPUT = 0.90)
JSI METAL = 0.04 (A) (INPUT = 1.00)




Structural component only
DWG# T-2007659

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408224	C40	2	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 26 10:19:12 2020 Page 1
ID:DMCubINVR6TstFoe31v6I zns11-PzsbYo7LL16uKVXgD50VpshpV5QUojwXujdzME8?

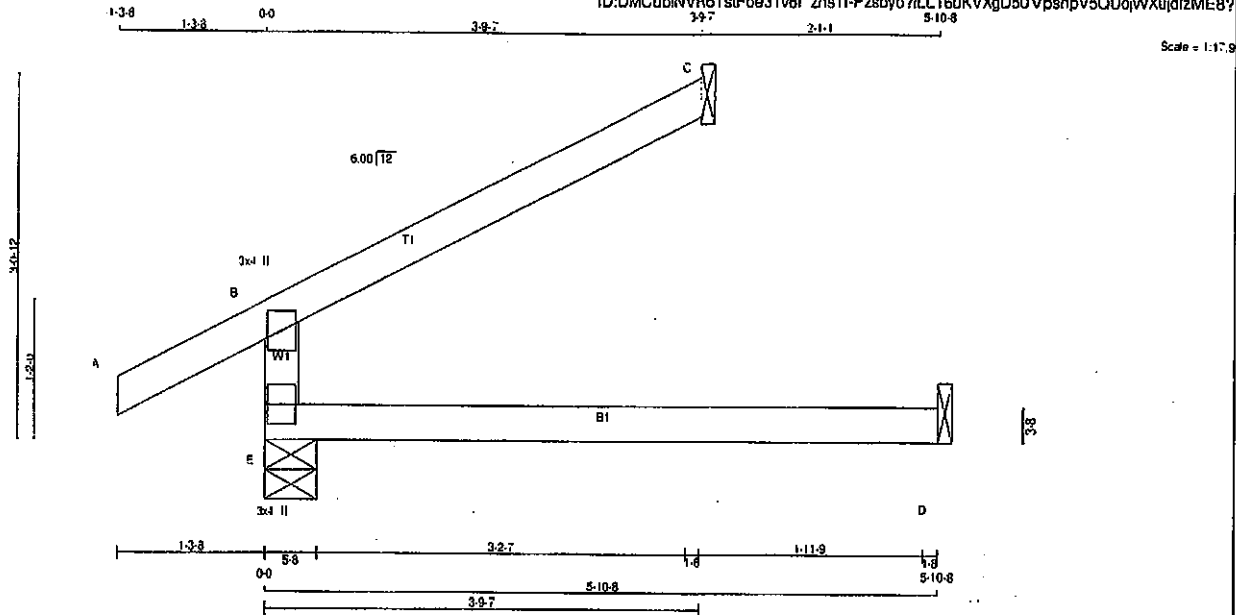

Scale = 1:17.9

LUMBER

N. L. G. A. RULES			
CHORDS	SIZE		LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
E	405	0	405	0	5-8	5-8
C	130	0	130	0	1-8	1-8
D	45	0	50	0	1-8	1-8

SEE MTEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
		COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
E	288	190	0	0	0	0	0
C	90	73	0	0	0	17	0
D	38	0	0	0	0	38	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS						
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (LBS)	LC1 (PLF)	MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB. FR-TO	MAX. FORCE (LBS)	FACTORED VERT. LOAD (LBS)	LC1 (PLF)	MAX. CSI (LC)
FR-TO										
E-B	-342	0	0.0	0.0	0.13 (4)	7.91				
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00				
B-C	-19	0	-91.8	-91.8	0.22 (1)	6.25				
E-D	0	0	-18.5	-18.5	0.13 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.22(1.00) (B-C:1), BC=0.13(1.00) (D-E:4), WB=0.00(1.00) (A-B:0), SS=0.15(1.00) (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	816 354	1687 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (E)/INPUT = 0.90
JSI METAL= 0.09 (B)/INPUT = 1.00

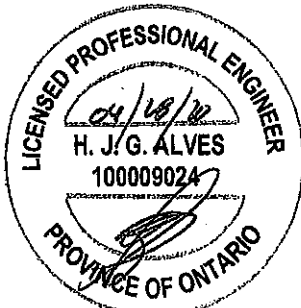


Structural component only
DWG# T-2007648

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	C41	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 26 10:19:44 2020 Page 1
ID:DMCubINVR6TsiF0e3Iv6I zns11-LM MINT0?lyHq7dIv0e7UaEx3uJnoyDCMrNqgYzME7z
5-10-8

Scale = 1/16"

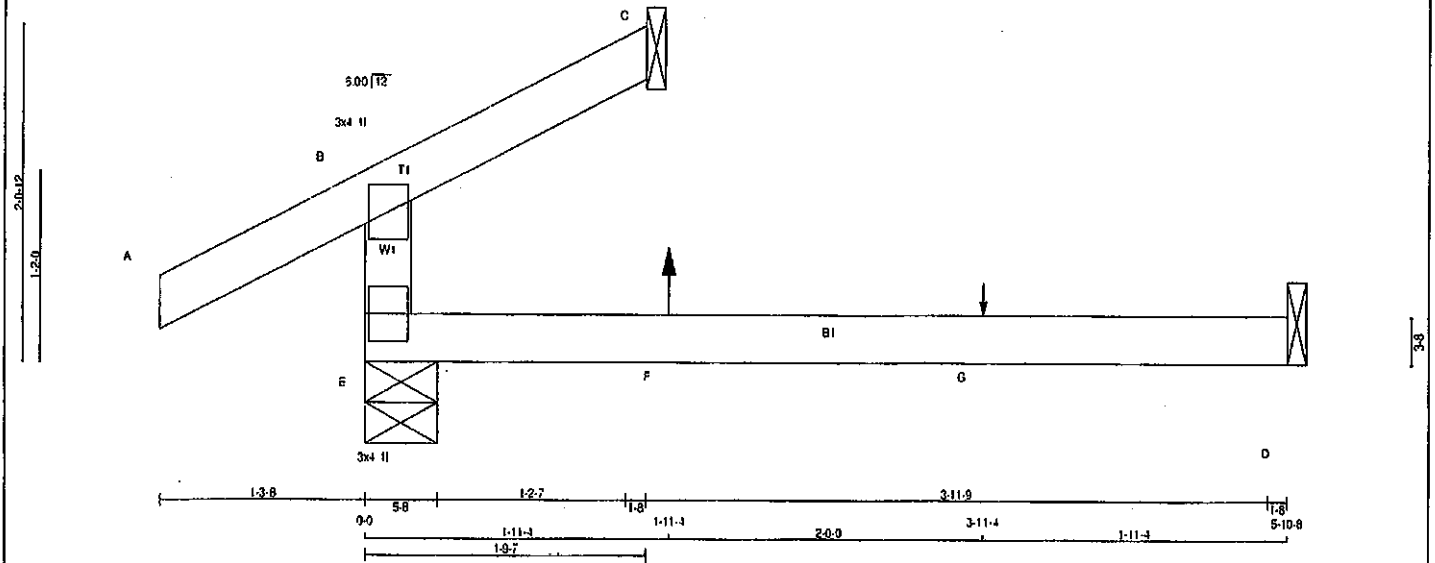

TOTAL WEIGHT = 2 X 12 = 23 lb
[M]

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF		
A - C	2x4	DRY	No.2	SPF		
E - D	2x4	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT	TYPE	PLATES	W	LEN	V	X
B	TMV+p	MT20	3.0	4.0			
E	BMV1+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED		GROSS REACTION		INPUT		RECORD	
	VERT	HORZ	DOWN	HORZ	BRG	BRG	IN-SX	IN-SX
E	284	0	284	0	5-8	5-8		
C	63	0	63	0	1-8	1-8		
D	44	0	52	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
E	200	137	0	0	0	62	0
C	46	21	0	0	0	25	0
D	35	0	-3	0	0	37	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (7)

CHORDS				W E B S				
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (LBS)	LC1 (PLF)	MAX CS1 (LC)	MAX. UNBRAC LENGTH	MEMB. FR-TO	MAX. FORCE (LBS)	FACTORED MAX CS1 (LC)
FR-TO		FROM						
E-B	-227 0	0.0	0.0	0.11 (4)	7.81			
A-B	0 28	-91.8	-91.8	0.12 (1)	10.00			
B-C	-9 9	-91.8	-91.8	0.08 (4)	10.00			
E-F	0 0	-18.5	-18.5	0.14 (4)	10.00			
F-G	0 0	-18.5	-18.5	0.14 (4)	10.00			
G-D	0 0	-18.5	-18.5	0.14 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
F	1-11-4	7	1	12	BACK	VERT	TOTAL		C1
G	3-11-4	1	1		BACK	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6	PSF
DL	= 8.0	PSF
BOT CH. LL	= 0.0	PSF
DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.12:1.00 (A-B:1), BC=0.14:1.00 (D-E:1), WB=0.09:1.00 (A-A:1), SS=0.09:1.00 (A-B:1)

DOL LUMBER=0.98 NAIL=0.98 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1667 788 1887 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.80)
JSI METAL= 0.08 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007649


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	C42	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 \$ Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:45 2020 Page 1

ID:DMCubINVR6TstFoe31v6I zns11-pYYkap1eeGPhnE6LL6j7RUC2j9wh9SMbV7NC zME7y

Scale = 1:10.2

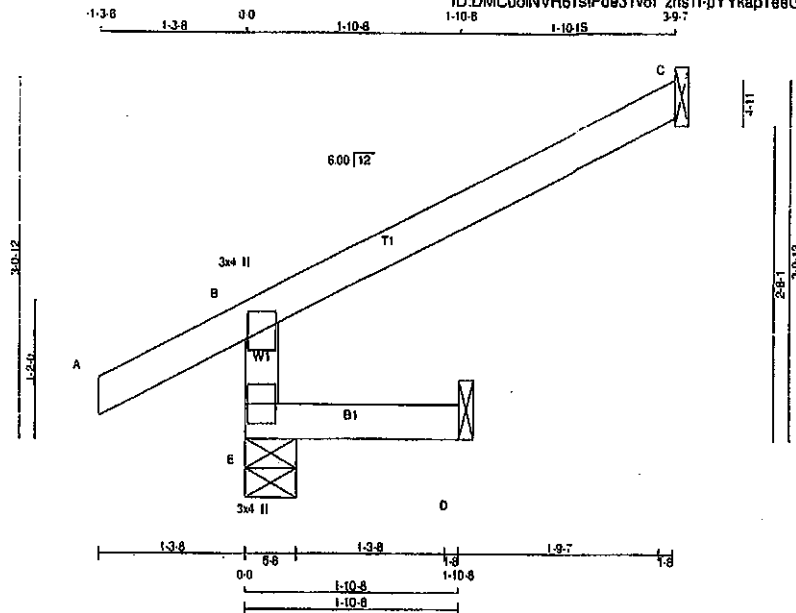

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	ORY	No.2	
A - C	2x4	ORY	No.2	
E - D	2x4	ORY	No.2	

DRY, SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
E	361 0	361 0	5-8	5-8
C	130 0	130 0	1-8	1-8
D	10 0	17 0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	250	190 0	0 0	0 0	0 0	80 0	0 0
C	90	73 0	0 0	0 0	0 0	17 0	0 0
D	12	0 0	0 0	0 0	0 0	12 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH
FR-TO						FR-TO			
E-B		-342 0	0.0	0.0	0.01 (4)	7.81			
A-B		0 28	-91.8	-91.8	0.13 (5)	10.00			
B-C		-19 0	-91.8	-91.8	0.22 (1)	6.25			
E-D		0 0	-18.5	-18.5	0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBCG 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

156 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19')
CALCULATED VERT. DEFL.(LL) = L/999 (0.00')
ALLOWABLE DEFL.(TL) = L/360 (0.19')
CALCULATED VERT. DEFL.(TL) = L/999 (0.00')

CSI: TC=0.22(1.00 (B-C:1), BC=0.02(1.00 (D-E:4), WB=0.00(1.00 (V&O), SS=0.15(1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION	(PSI)	(PLI)	(PLI)
MAX MIN MAX MIN MAX MIN			
MT20	618	354	1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (E) (INPUT = 0.99)
JSI METAL= 0.09 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007650

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408224	C43	3	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 9.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:19:46 2020 Page 1
ID:DMCubINVR6TstF0e31v6l_zns11-lk66o92GPaxYNxplv39yff10Q6VqQcIVq9xllRzME7x

Scale = 1/13,1

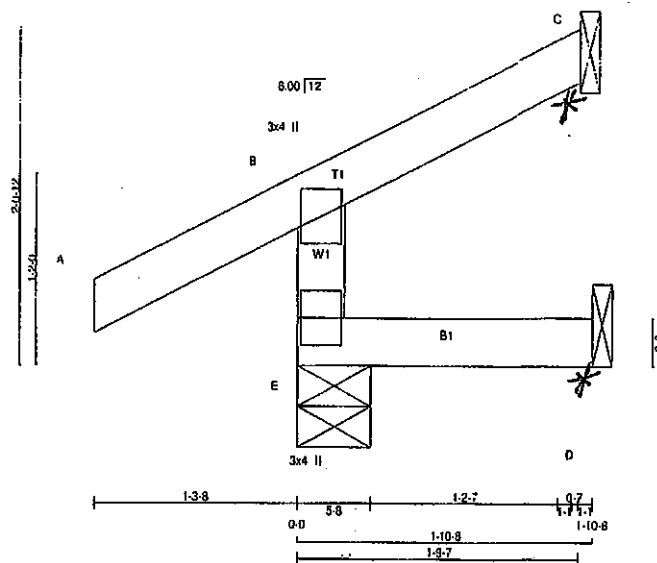

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF		
A - C	2x4	DRY	No.2	SPF		
E - D	2x4	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	UPLIFT
E	271	0	271	0
C	45	0	45	0
D	8	0	17	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE			
E	188	141	0	0	0	0
C	31	24	-18	0	0	0
D	7	0	-8	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
E-B	244	0	0.0	0.0	0.04 (5)	7.81	
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00	
B-C	-17	0	-91.8	-91.8	0.09 (1)	6.25	
E-D	0	0	-18.5	-18.5	0.04 (5)	10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 7 = 21 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), SC=0.04/1.00 (D-E:5),
WB=0.00/1.00 (n/a:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	818	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007651

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C44	2	1	GREEN PARK HOMES	


Tamarack Roof Truss, Burlington

TRUSS DESC.

Version 8.310 S Oct 29 2019 MTak Industries, Inc. Tue Apr 28 10:19:47 2020 Page 1

ID:DMCubINVR6TsiFoe31v6I zns11-mxgU?V3uAtIP 5OUTmhBCaZYWqD93ye2pcUHzME7w

Scale = 1:17.0

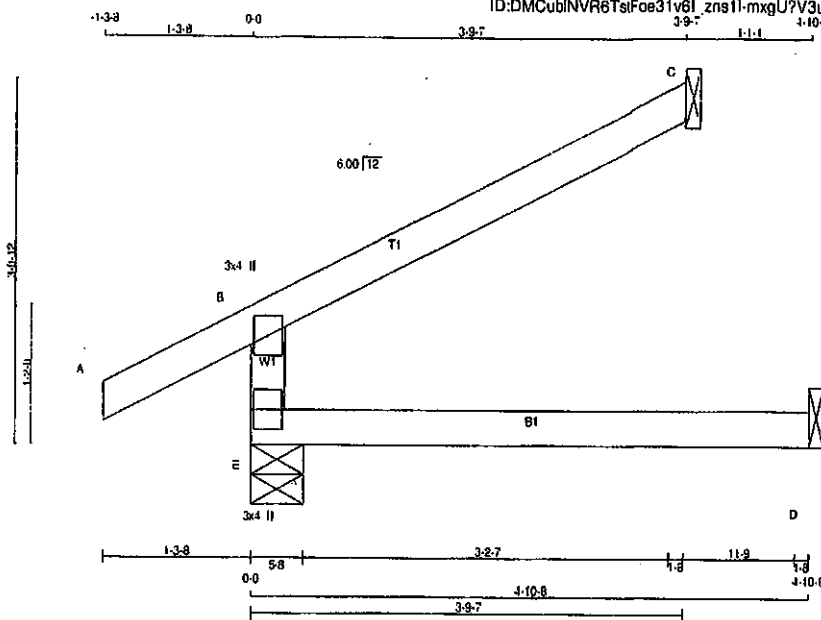

TOTAL WEIGHT = 2 X 13 = 26 lb

LUMBER

N. L. G. A. RULES	SIZE	LUMBER
CHORDS	2x4	DRY No.2
E - B	2x4	DRY No.2
A - C	2x4	DRY No.2
E - D	2x4	DRY No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
E	394	0	394	0
C	130	0	130	0
D	38	0	42	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	277	190	0	0	0	0	87	0
C	90	73	0	0	0	0	17	0
D	30	0	0	0	0	0	30	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LBS)	MAX. UNBRACED LENGTH	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CS (LBS)
FR-TO								
E-B	-342	0	0.0	0.0	0.08 (4)	7.81		
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00		
B-C	-19	0	-91.8	-91.8	0.22 (1)	6.25		
E-D	0	0	-18.5	-18.5	0.09 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOY CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.22:1.00 (B-C:1), BC=0.09:1.00 (D-E:4), WB=0.00:1.00 (max:0), SSI=0.15:1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	818	354
	1667	788
	1987	1656


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.14 (E) (INPUT = 0.80)
JSI METAL = 0.09 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007652

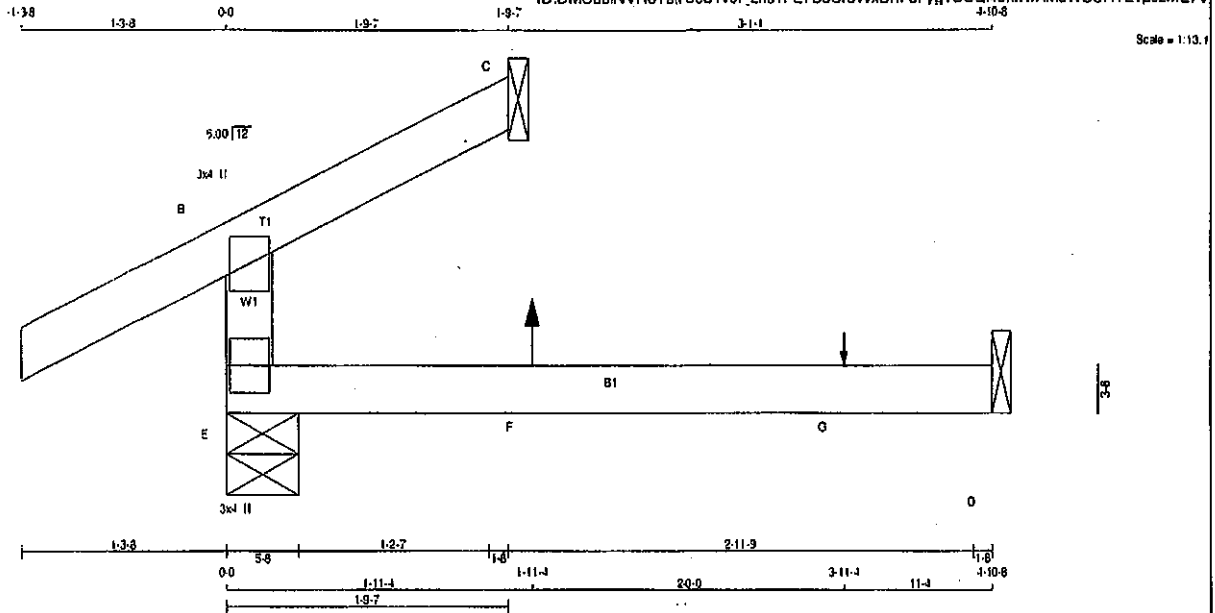

TOTAL WEIGHT = 2 X 10 = 21 lb (M)

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED		MAXIMUM FACTORED		INPUT	RECORD
	GROSS REACTION	DOWN	GROSS REACTION	UP		
E	282	0	282	0	5-8	5-8
C	55	0	55	0	1-8	1-8
D	35	0	44	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS				DEAD	SOL
		SNOW	LIVE	PERM. LIVE	WIND		
E	198	137	0	0	0	61	0
C	39	21	0	0	0	18	0
D	29	0	4	0	0	31	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (7)

MEMB.	CHORDS		WEBS		MEMB.	WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)
FR-TO					FR-TO		
E-B	-235	0	0.0	0.0	7.81		
A-B	0	28	-91.8	-91.8	10.00		
B-C	-13	5	-91.8	-91.8	10.00		
E-F	0	0	-18.5	-18.5	10.00		
F-G	0	0	-18.5	-18.5	10.00		
G-D	0	0	-18.5	-18.5	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	1-11-4	7	1	12	BACK	VERT	TOTAL	---	C1
G	3-11-4	1	1	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.8 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, CBC 2012, ABC 2018
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
 - OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
 ALLOWABLE DEFL.(TL) = L/360 (0.19")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.12/1.00 (A-9:1), BC=0.10/1.00 (D-E:4),
 WB=0.00/1.00 (A-B:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)
 JSI METAL = 0.07 (B) (INPUT = 1.00)




Structural component only
 DWG# T-2007653

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	C46	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MitTek Industries, Inc. Tue Apr 26 10:18:49 2020 Page 1
ID:DMCubINVR6TslFoe31v6l zns1l-iJnEQB48hUv8EPXlaBjHhKKVjdZSxW75bLizME7u

Scale = 1:18.2

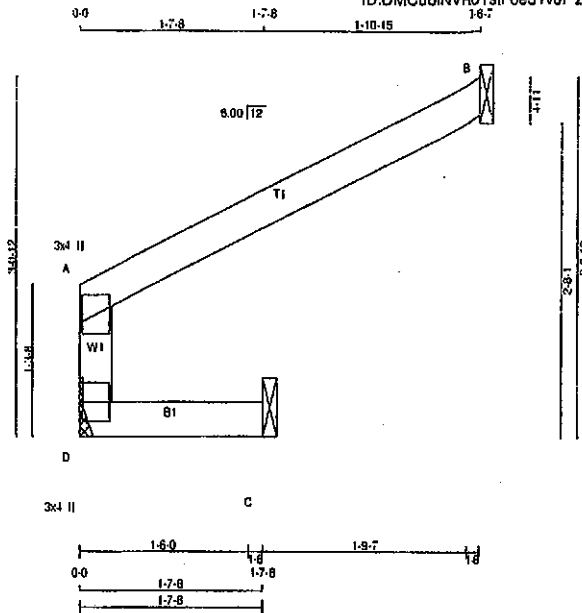

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
D - A	2x4	DRY	No.2
A - B	2x4	DRY	No.2
D - C	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMV+p	MT20	3.0	3.0	
D	BMV+p	MT20	3.0	3.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG
D	156	0	156	0	0	0	0	MECHANICAL	
B	144	0	144	0	0	1-8	1-8		
C	55	0	55	0	0	1-8	1-8		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS		1ST CASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
D	109	78 0	0 0	0 0	0 0
B	99	80 0	0 0	0 0	0 0
C	40	23 0	0 0	0 0	0 0

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD LC1	MAX (PLF)	MAX. CS1 (LC)	UNBRAC LENGTH FR-TO	MEMB. FORCE (LBS)	MAX CS1 (LC)
FR-TO							
D-A	-181 0	0.0	0.0	0.08 (1)	7.81		
A-B	-8 0	-91.8	-91.8	0.14 (1)	10.00		
D-C	0 0	-18.5	-18.5	0.09 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NSCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19')
CALCULATED VERT. DEFL. (LL) = L/999 (0.00')
ALLOWABLE DEFL. (TL) = L/360 (0.19')
CALCULATED VERT. DEFL. (TL) = L/999 (0.00')

CS1: TC=0.14/1.00 (A-B:1), BC=0.09/1.00 (C-D:1),
WB=0.00/1.00 (A-B:0), SS1=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.08 (D) (INPUT = 0.80)
JSI METAL = 0.05 (A) (INPUT = 1.00)



Structural component only
DWG# T-2007654


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	C47	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:19:50 2020 Page 1

ID:DMCubINVR6T9iFoe31v6I zns1f-AWLddX5mSo1zrY638uEuqVB5sks7MQI5knq6uCzME7n

Scale = 1:13.1

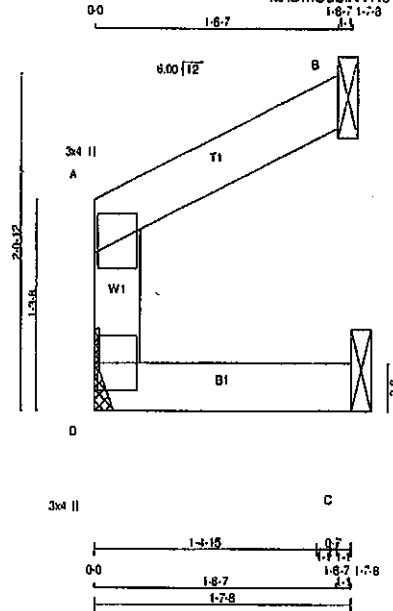

<u>LUMBER</u>					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR
D - A	2x4	DRY	No.2		SPF
A - B	2x4	DRY	No.2		SPF
D - C	2x4	DRY	No.2		SPF
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0			
O	BMV1+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORIZ	GROSS REACTION	DOWN	HORIZ	UPLIFT	BRG	BRG
D	88	0	88	0	0	0	0	MECHANICAL	
B	87	0	67	0	0	1-8	1-8		
C	19	0	19	0	0	1-8	1-8		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	81	39 0	0 0	0 0	0 0	0 0	21 0	0 0
B	46	37 0	0 0	0 0	0 0	0 0	9 0	0 0
C	14	2 0	0 0	0 0	0 0	0 0	12 0	0 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PL)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	MAX. CSI (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
D-A	-74 0	0.0	0.0 0.01 (1)	7.81			
A-B	-2 0	-91.8	-91.8 0.03 (1)	10.00			
D-C	0 0	-18.5	-18.5 0.01 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:	
TOP CH.	LL = 25.6 PSF
DL	= 6.0 PSF
BOT CH.	LL = 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.03 (A-B:1), BC=0.01 (1.00 (C-D:4), WB=0.00 (1.00 (m/a:0), SSI=0.05 (1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 (S BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 518 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.03 (D) INPUT = 0.90
JSI METAL= 0.02 (A) INPUT = 1.00



Structural component only
DWG# T-2007655

LUL/LUS/LJS/HUS/HHUS/HGUS

SIMPSON
Strong-Tie

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LJS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 268–259.

Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp.20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options Information on p. 126.




Double-Shear
Nailing
Top View




Double-Shear
Nailing
Side View;
Do not
bend tab




Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,580

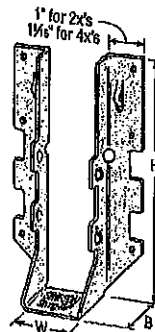


LUS28




LU26L

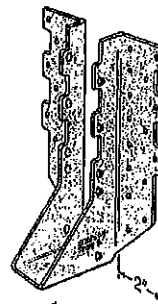


HUS210
(HUS26, HUS28,
and HHUS similar)



HGUS28-2




HHUS210-2



LJS26DS

**Typical HUS28
Installation
with Reduced
Heel Height**
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

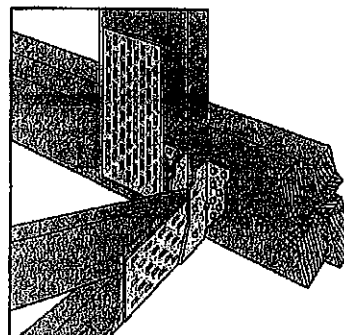

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options Information on pp. 125-127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
W < 2"	Bevel or square cut	0.82 of table value	0.46 of table value
2" < W < 6"	Bevel cut	0.67 of table value	0.41 of table value
2" < W < 6"	Square cut	0.46 of table value	0.41 of table value
W > 6"	Bevel cut	0.75 of table value	0.41 of table value

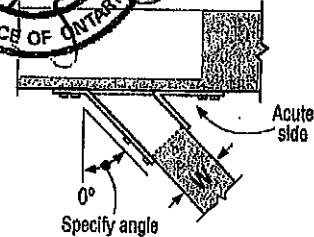

**Top View HHUS Hanger
Skewed Right**
(joist must be bevel cut)
All joist nails installed on the
outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive[®] SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _g ³	Header	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN	(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN
Single 2x Sizes											
LUS24	18	1 1/8	3 1/2	1 1/2	2 1/2	(4) 10d	(2) 10d	710 360 160	1626 1020 464	645 320 142	1155 726 322
LU24L	22	1 1/8	3	1 1/2	2 1/8	(4) 10d	(2) 10d x 1 1/2"	720 320 160	1606 1020 464	646 320 142	1140 726 322
LU26L	22	1 1/8	5	1 1/2	4 1/2	(6) 10d	(4) 10d x 1 1/2"	720 320 160	1606 1020 464	646 320 142	1140 726 322
LUS26	18	1 1/8	4 1/2	1 1/2	3 3/4	(4) 10d	(4) 10d	1420 632	2170 965	1290 574	1630 725
								2705 1180	4940 2197	2065 920	3675 1724
HUS26	18	1 1/8	5 1/2	3	3 3/8	(14) 16d	(6) 16d	2705 1180	4940 2197	2065 920	3675 1724
								2055 914	4265 1897	1480 649	4115 1831
LJS26DS	18	1 1/8	5	3 1/2	4 1/2	(16) 16d	(6) 16d	2055 914	4265 1897	1480 649	4115 1831
								2885 1196	6625 2951	2685 1196	6700 2535
HGUS26	12	1 1/8	5 1/2	5	4 1/2	(20) 16d	(8) 16d	2885 1196	6625 2951	2685 1196	6700 2535
								1140 507	2185 972	1020 464	1550 689
LU28L	20	1 1/8	6 1/2	1 1/2	5 1/2	(8) 10d	(6) 10d x 1 1/2"	1140 507	2185 972	1020 464	1550 689
								1420 632	2520 1121	1290 574	1790 796
LUS28	18	1 1/8	6 1/2	1 1/2	3 3/4	(6) 10d	(4) 10d	1420 632	2520 1121	1290 574	1790 796
								3605 1604	5385 2388	2675 1190	4345 1933
HUS28	16	1 1/8	7 1/8	3	6 1/8	(22) 18d	(8) 18d	3605 1604	5385 2388	2675 1190	4345 1933
								3310 1474	7675 3419	3310 1474	6900 3073
HGUS28	12	1 1/8	7 1/8	5	6 1/2	(36) 18d	(12) 18d	3310 1474	7675 3419	3310 1474	6900 3073
								1140 507	2495 1110	1020 464	1770 787
LU210L	20	1 1/8	8	1 1/2	7 1/2	(10) 10d	(6) 10d x 1 1/2"	1140 507	2495 1110	1020 464	1770 787
								1420 632	2785 1239	1290 574	2210 983
LUS210	18	1 1/8	7 1/8	1 1/2	3 3/4	(8) 10d	(4) 10d	1420 632	2785 1239	1290 574	2210 983

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_g is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.182" dia. x 3 1/2" long. See pp. 27-28 for other nail sizes and information.

Face-Mount Hangers

SIMPSON

Strong-Tie

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _a ¹	Header	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb.	(K _D = 1.00) lb.	(K _D = 1.15) lb.	(K _D = 1.00) lb.
								kN	kN	kN	kN
Double 2x Sizes											
LUS24-2	18	3 3/8	3 3/8	2	1 1/2	(4) 16d	(2) 16d	835 3.71	2020 8.99	590 2.62	1435 6.38
LUS26-2	18	3 3/8	4 3/8	2	4	(4) 16d	(4) 16d	1720 7.65	2595 11.54	1545 6.87	1920 8.54
HHUS26-2	14	3 3/8	5 3/8	3	3 1/8	(14) 16d	(6) 16d	2850 12.68	7335 32.63	2065 9.20	5205 23.15
HGUS26-2	12	3 3/8	5 3/8	4	4 1/8	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
LUS28-2	18	3 3/8	7	2	4	(8) 16d	(4) 16d	1720 7.65	3325 14.79	1545 6.87	2575 11.45
HHUS28-2	14	3 3/8	7 3/8	3	6 3/8	(22) 16d	(8) 16d	3765 16.75	8940 39.77	2675 11.90	6345 28.22
HGUS28-2	12	3 3/8	7 3/8	4	8 3/8	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
LUS210-2	18	3 3/8	9	2	6	(8) 16d	(8) 16d	2580 11.48	4500 20.02	2320 10.32	3195 14.21
HHUS210-2	14	3 3/8	9 3/8	3	8	(30) 16d	(10) 16d	4670 20.77	9660 42.97	4235 18.84	7000 31.14
HGUS210-2	12	3 3/8	9 3/8	4	8 1/8	(46) 16d	(16) 16d	6840 30.43	14015 62.34	4855 21.60	10270 45.69
Triple 2x Sizes											
HGUS26-3	12	4 3/8	5 1/2	4	4 1/8	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
HGUS28-3	12	4 3/8	7 1/4	4	6 3/8	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
HHUS210-3	14	4 3/8	9	3	7 3/8	(30) 16d	(10) 16d	4670 20.77	9660 43.02	4235 18.84	6865 30.64
HGUS210-3	12	4 3/8	9 1/4	4	8 3/8	(46) 16d	(16) 16d	6840 30.43	14645 65.14	4855 21.60	10400 46.26
Quadruple 2x Sizes											
HGUS26-4	12	6 3/8	5 3/8	4	4 1/8	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
HGUS28-4	12	6 3/8	7 3/8	4	6 3/8	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
HHUS210-4	14	6 3/8	8 3/8	3	7 3/8	(30) 16d	(10) 16d	4670 20.77	10155 45.17	4235 18.84	7210 32.07
HGUS210-4	12	6 3/8	9 3/8	4	8 3/8	(46) 16d	(16) 16d	6840 30.43	14645 65.14	4855 21.60	10400 46.26
HGUS212-4	12	8 3/8	10 3/8	4	10 3/8	(56) 16d	(20) 16d	7640 33.98	14995 66.70	5425 24.13	10645 47.35
HGUS214-4	12	6 3/8	12 3/8	4	11 3/8	(66) 16d	(22) 16d	10130 45.06	16400 72.95	7195 32.00	11645 51.80
4x Sizes											
LUS46	18	3 3/8	4 3/4	2	3 3/8	(4) 16d	(4) 16d	1720 7.65	2595 11.54	1545 6.87	1920 8.54
HHUS46	14	3 3/8	5 3/4	3	3 3/8	(14) 16d	(6) 16d	2540 11.30	7335 32.63	2065 9.20	5205 23.15
HGUS46	12	3 3/8	5 3/4	4	4 3/8	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
LUS48	18	3 3/8	6 3/4	2	3 3/8	(8) 16d	(4) 16d	1720 7.65	3325 14.79	1545 6.87	2575 11.45
HHUS48	14	3 3/8	7 1/4	3	6 3/8	(22) 16d	(8) 16d	3765 16.75	8940 39.77	2675 11.90	6345 28.22
HGUS48	12	3 3/8	7 3/8	4	6 3/8	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
LUS410	18	3 3/8	8 3/4	2	5 3/8	(8) 16d	(8) 16d	2580 11.48	4500 20.02	2320 10.32	3195 14.21
HGUS410	12	3 3/8	9	4	8 3/8	(46) 16d	(16) 16d	6840 30.43	14015 62.34	4855 21.60	10270 45.69
HGUS412	12	3 3/8	10 3/8	4	10 3/8	(56) 16d	(20) 16d	7640 33.98	14995 66.70	5425 24.13	10645 47.35
HGUS414	12	3 3/8	12 3/8	4	11 3/8	(66) 16d	(22) 16d	10130 45.06	16400 72.95	7195 32.00	11645 51.80

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1/4". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

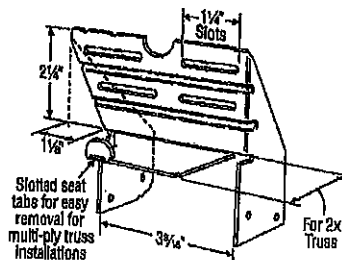


TC24
U.S. Patent 4,832,173

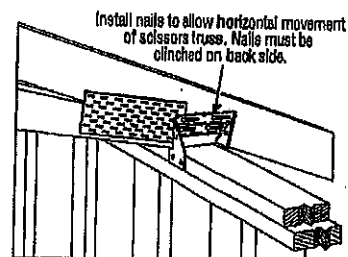


Typical TC24 Installation

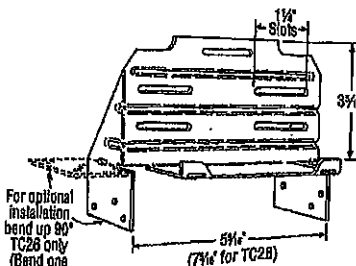

TC26
(TC28 Similar)

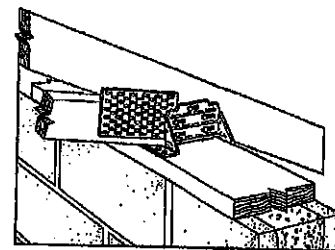

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer
(8", 10", 12" Wall Installation Similar)

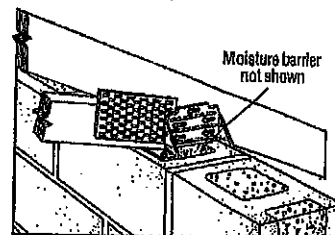

Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _u =1.15)	Uplift (K _u =1.15)
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(6) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _u =1.15)	Uplift (K _u =1.15)
TC26	(5) 10d	(6) 10d x 1 1/2"	810	660
	(5) 10d	(6) 10d	930	660

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.
2. Grout strength is 15 MPa minimum.
3. Optional TC26 installation with 10d nails requires minimum 3" top plate thickness.
4. TC26 fastened to grouted concrete block with (6) - 3/8" x 2 1/4" Titen screws has a factored uplift resistance of 275 lb.



AMT
STATES
DESIGN

1000 Highway 100, Unit 100
St. Catharines, Ontario L2R 6L1
Canada
Tel: (905) 681-1111
Fax: (905) 681-1112
Email: info@amtsdesign.com

© 2017 Simpson Strong-Tie Company

(800) 999-5099
strongtie.com

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_F = 1.15$)					
					D.Fir-L			S-P-F		
		To Rafters/Truss	To Plates	To Studs	Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(6) 8d x 1½"	(4) 8d	—	740	685	300	680	485	215
					3.29	3.05	1.33	3.02	2.16	0.98
SS H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
					3.58	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	160	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	265	615	125	190
					3.29	0.80	1.18	2.74	0.56	0.85
H6	16	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	670	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS H8	18	(5) 10d x 1½"	(5) 10d x 1½"	—	1120	—	—	1025	—	—
					4.98	—	—	4.56	—	—
SS H10A	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	565	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(8) 10d x 1½"	(8) 10d x 1½"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.54	1.36
H10A-2	18	(8) 10d x 1½"	(9) 10d x 1½"	—	1835	1275	430	1645	880	305
					8.18	5.67	1.91	7.32	3.91	1.36
H10S ^{2A}	18	(8) 8d x 1½"	(8) 8d x 1½"	(8) 8d	1465	795	315	1040	565	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2½"	(6) 16d x 2½"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	[1] (12) 8d x 1½"	(13) 8d	—	2390	855	320	1805	610	230
		[2] (12) 8d x 1½"	(15) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
TSP	18	(9) 10d x 1½"	(6) 10d x 1½"	—	1295	440	—	920	310	—
					5.76	1.98	—	4.09	1.38	—
		(9) 10d x 1½"	(6) 10d	—	1560	440	—	1105	310	—
					6.94	1.98	—	4.92	1.38	—

- Factored resistances have been increased 16% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 595 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-H/TIECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 6/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1½" nails into the top plates and (3) 8d x 1½" nails into the lowest three flange holes into the truss bottom chord is 485 lb. (2.20 kN).
- Nails: 16d x 2½" = 0.162" dia. x 2½" long, 10d = 0.148" dia. x 3" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long, 8d x 1½" = 0.131" dia. x 1½" long. See pp. 27-28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.180	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4.
10. This design is not valid after March 31, 2021.

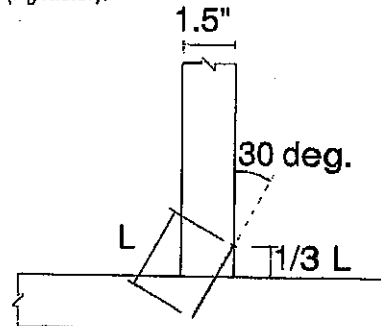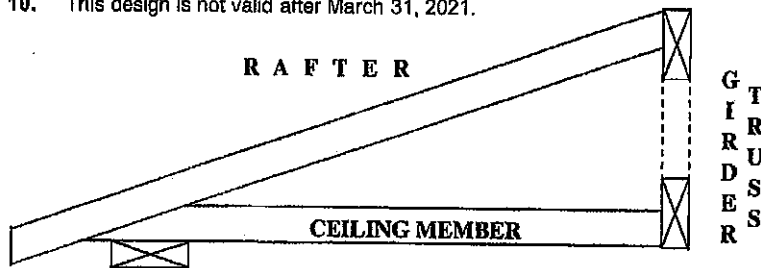

TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (In)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019

PEO
Certificate No. 10889486



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind** or **earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37679H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

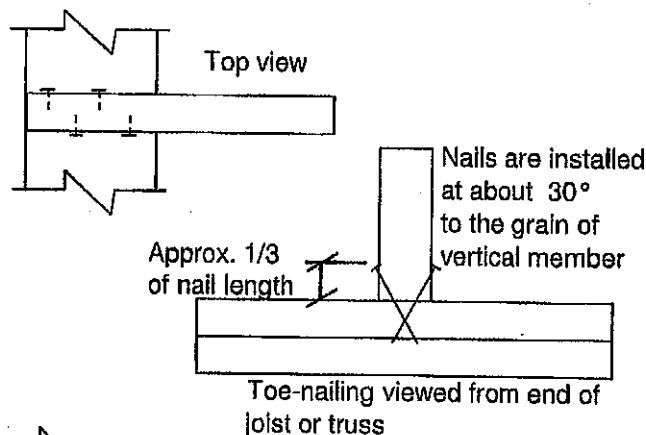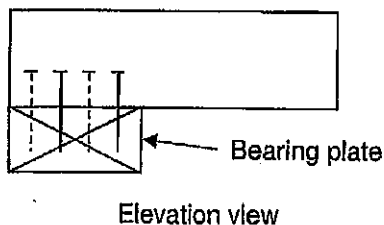

Toe-nailing on 2x4 Bearing Plate

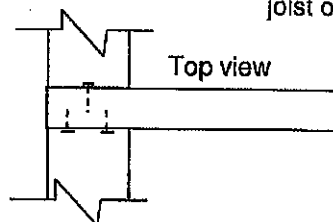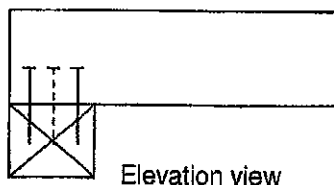


MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7




December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0 1/4" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

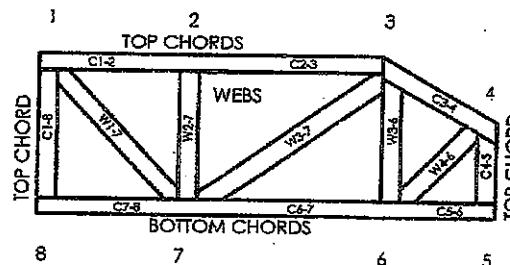

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MIT-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane of joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

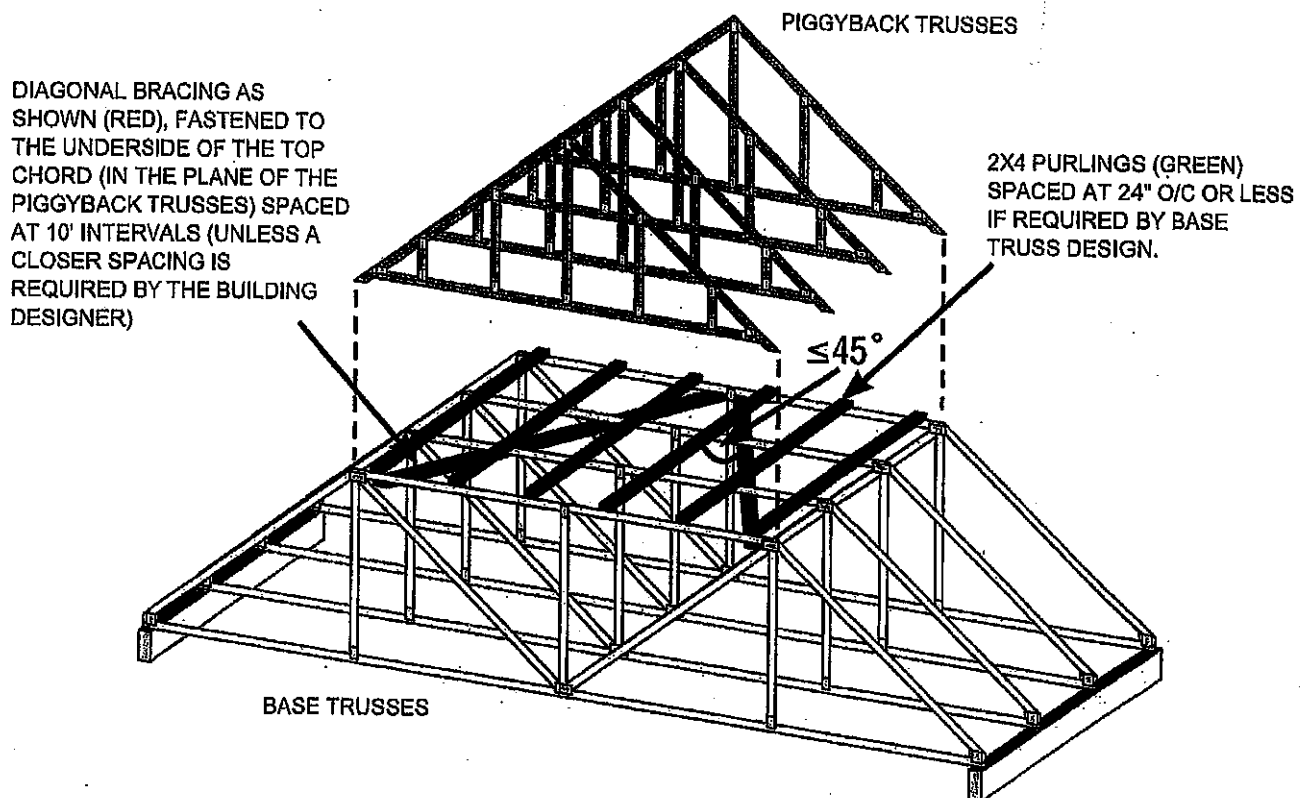

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1900213

Feb 09, 2018