


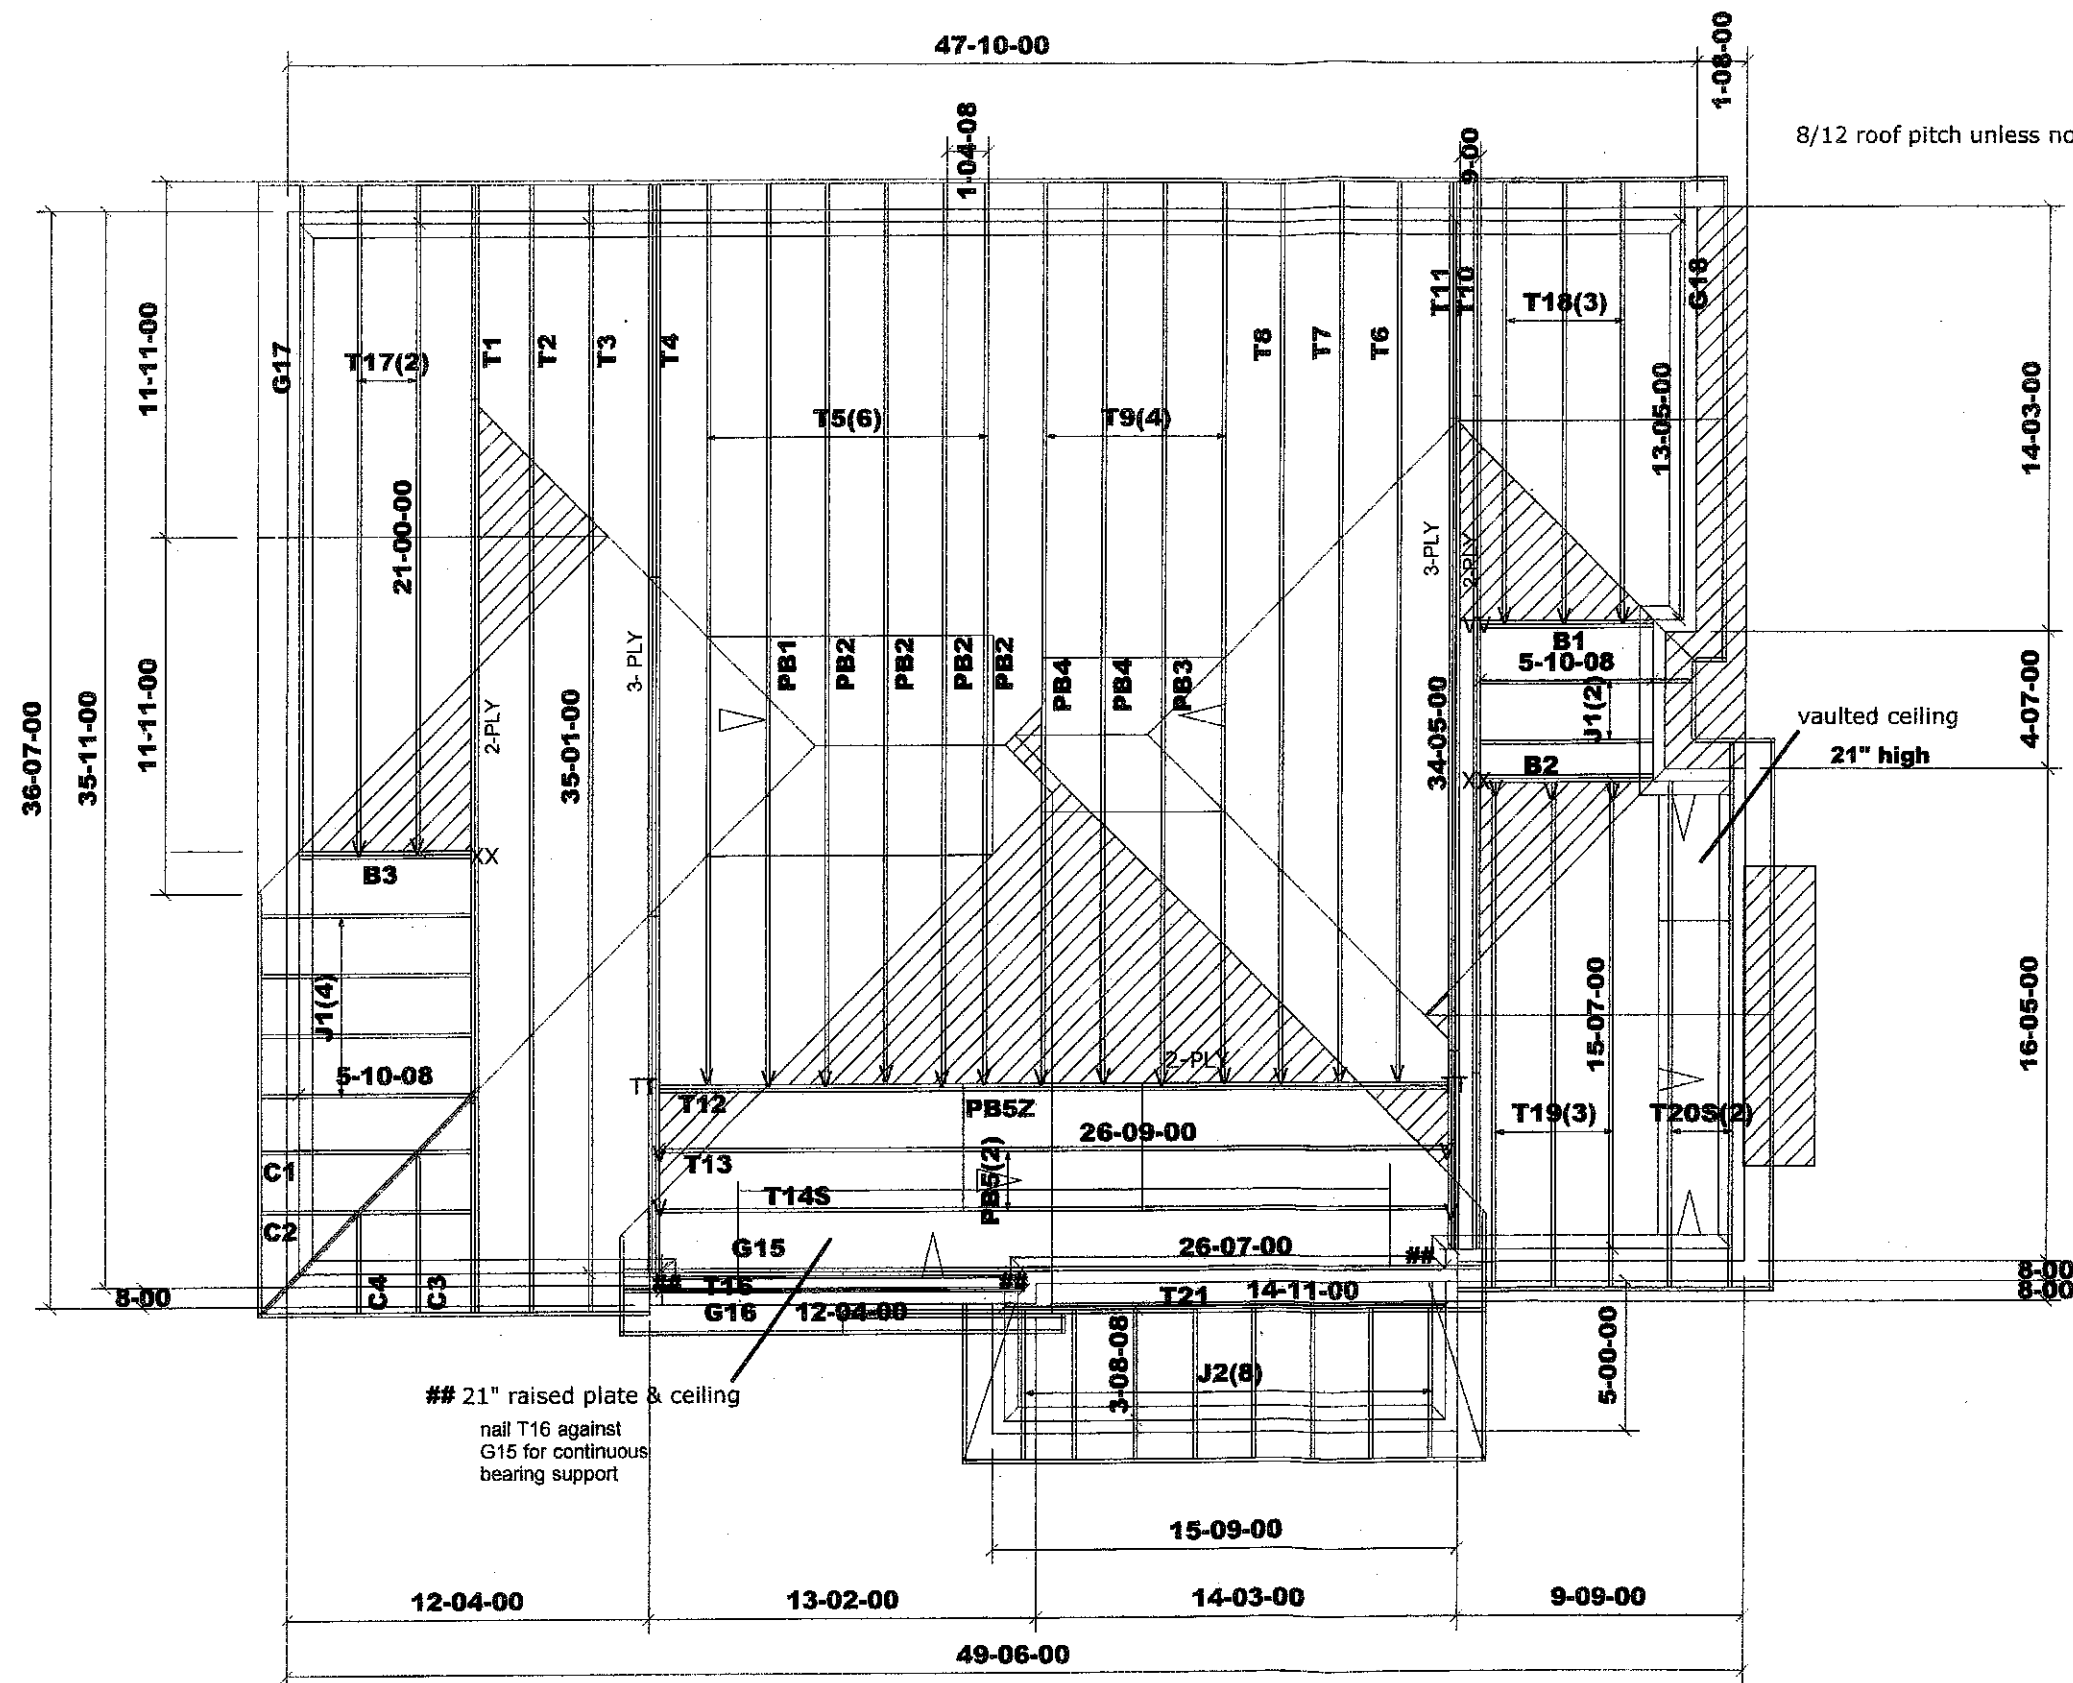

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.


All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
HGUS26-2 - (XX)
LJS26DS - (V)
THGQ2-SDS3(MAX) - (TT)
LUS26-2-(VV)

BEAMS:
B1= B2 = B3 =
2 - 2x10 SPF #2

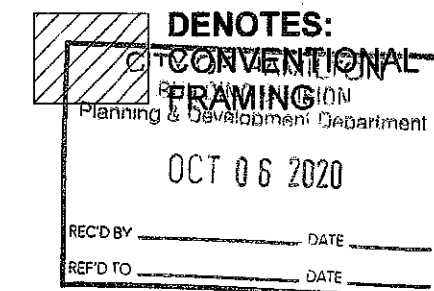

M1340




Job Track: 51225
Plan Log: 202439
Layout ID: 408315

Builder / Location: GREEN PARK HOMES / WATERDOWN
Project: RUSSELL GARDENS PH.3
Date: 2020-04-29 Sales: Mario DiCano Designer: JG

Model / Elevation: MOUNTAINASH 12/1

Milek ver 8.3.1.215

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE

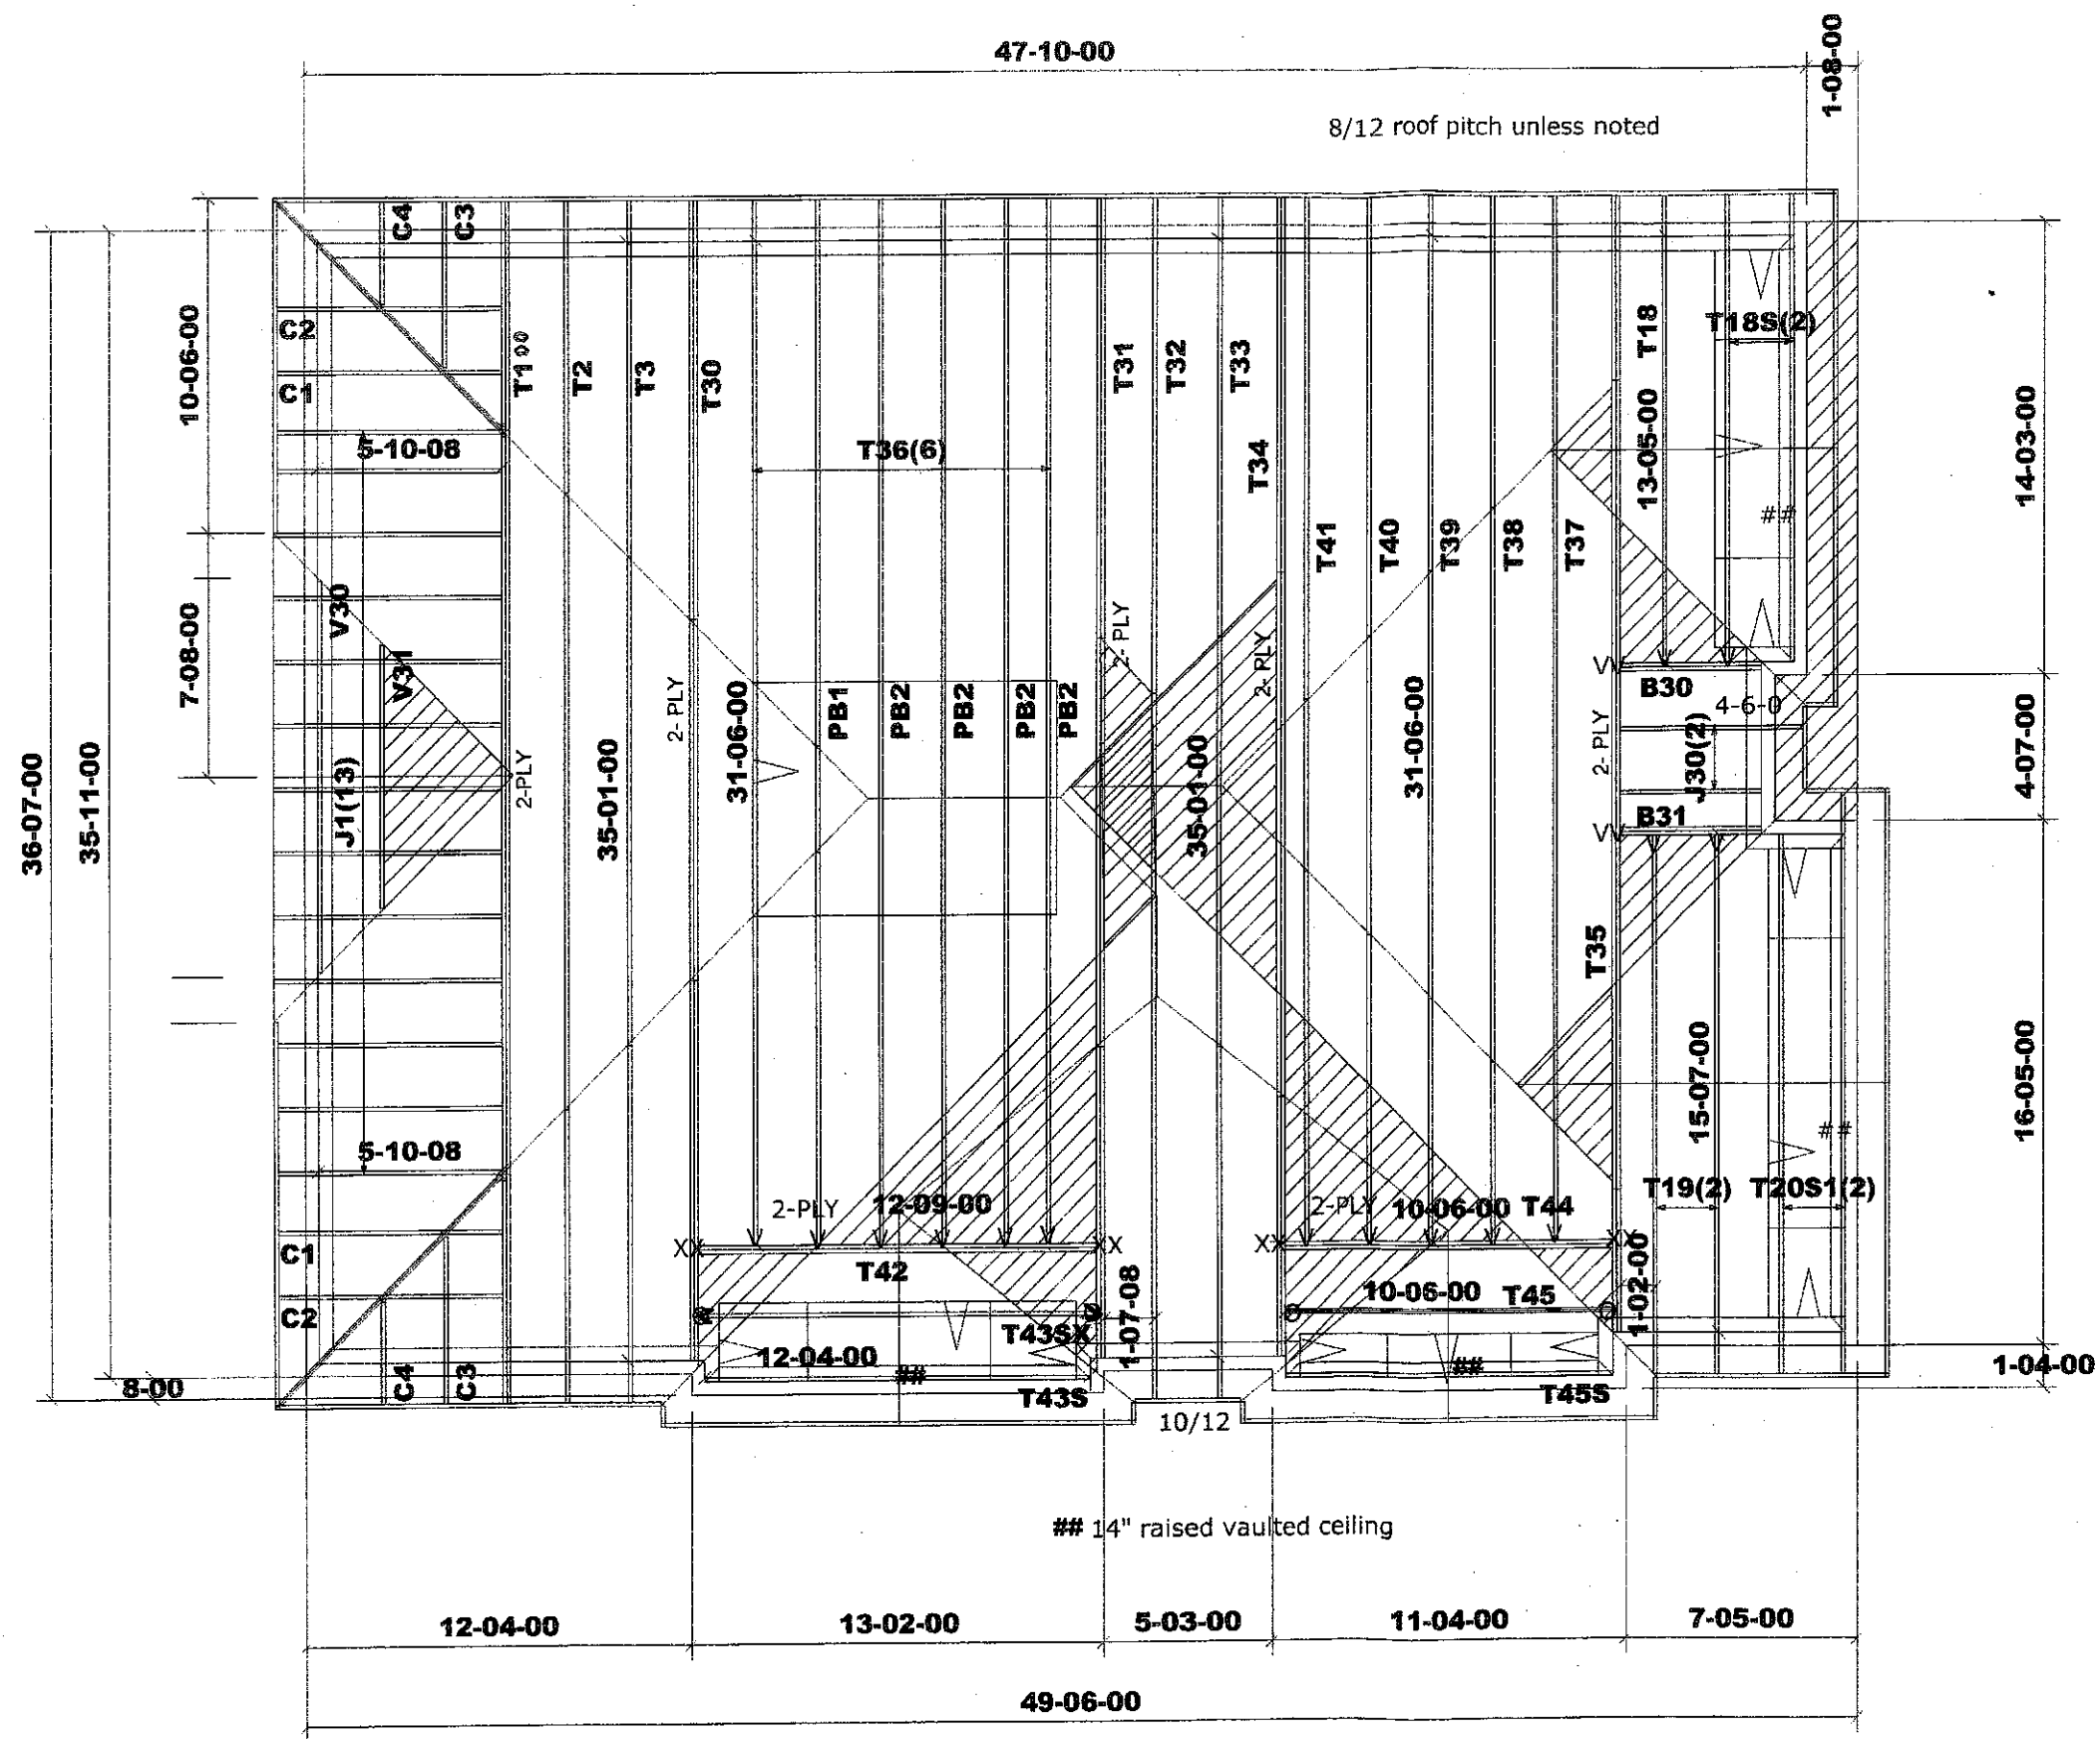

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.


All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012
(2019 amendment) OCCUPANCY:
RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
HGUS26-2 - (XX)
LJS26DS - (V)
LUS24 - (O)
LUS26-2-(VV)

BEAMS:
B30= B31 =
2 - 2x10 SPF #2

 DENOTES:
CONVENTIONAL
FRAMING

M13140




Job Track **51225**
Plan Log: **202439**
Layout ID: **408316**

Builder / Location:
GREEN PARK HOMES / WATERDOWN
Project: **RUSSELL GARDENS PH.3**
Date: 2020-04-29 Sales: **Mario DiCano** Designer: JG

Model / Elevation:
MOUNTAINASH 12/2

Mitek ver 8.3.1.215

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC.. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE

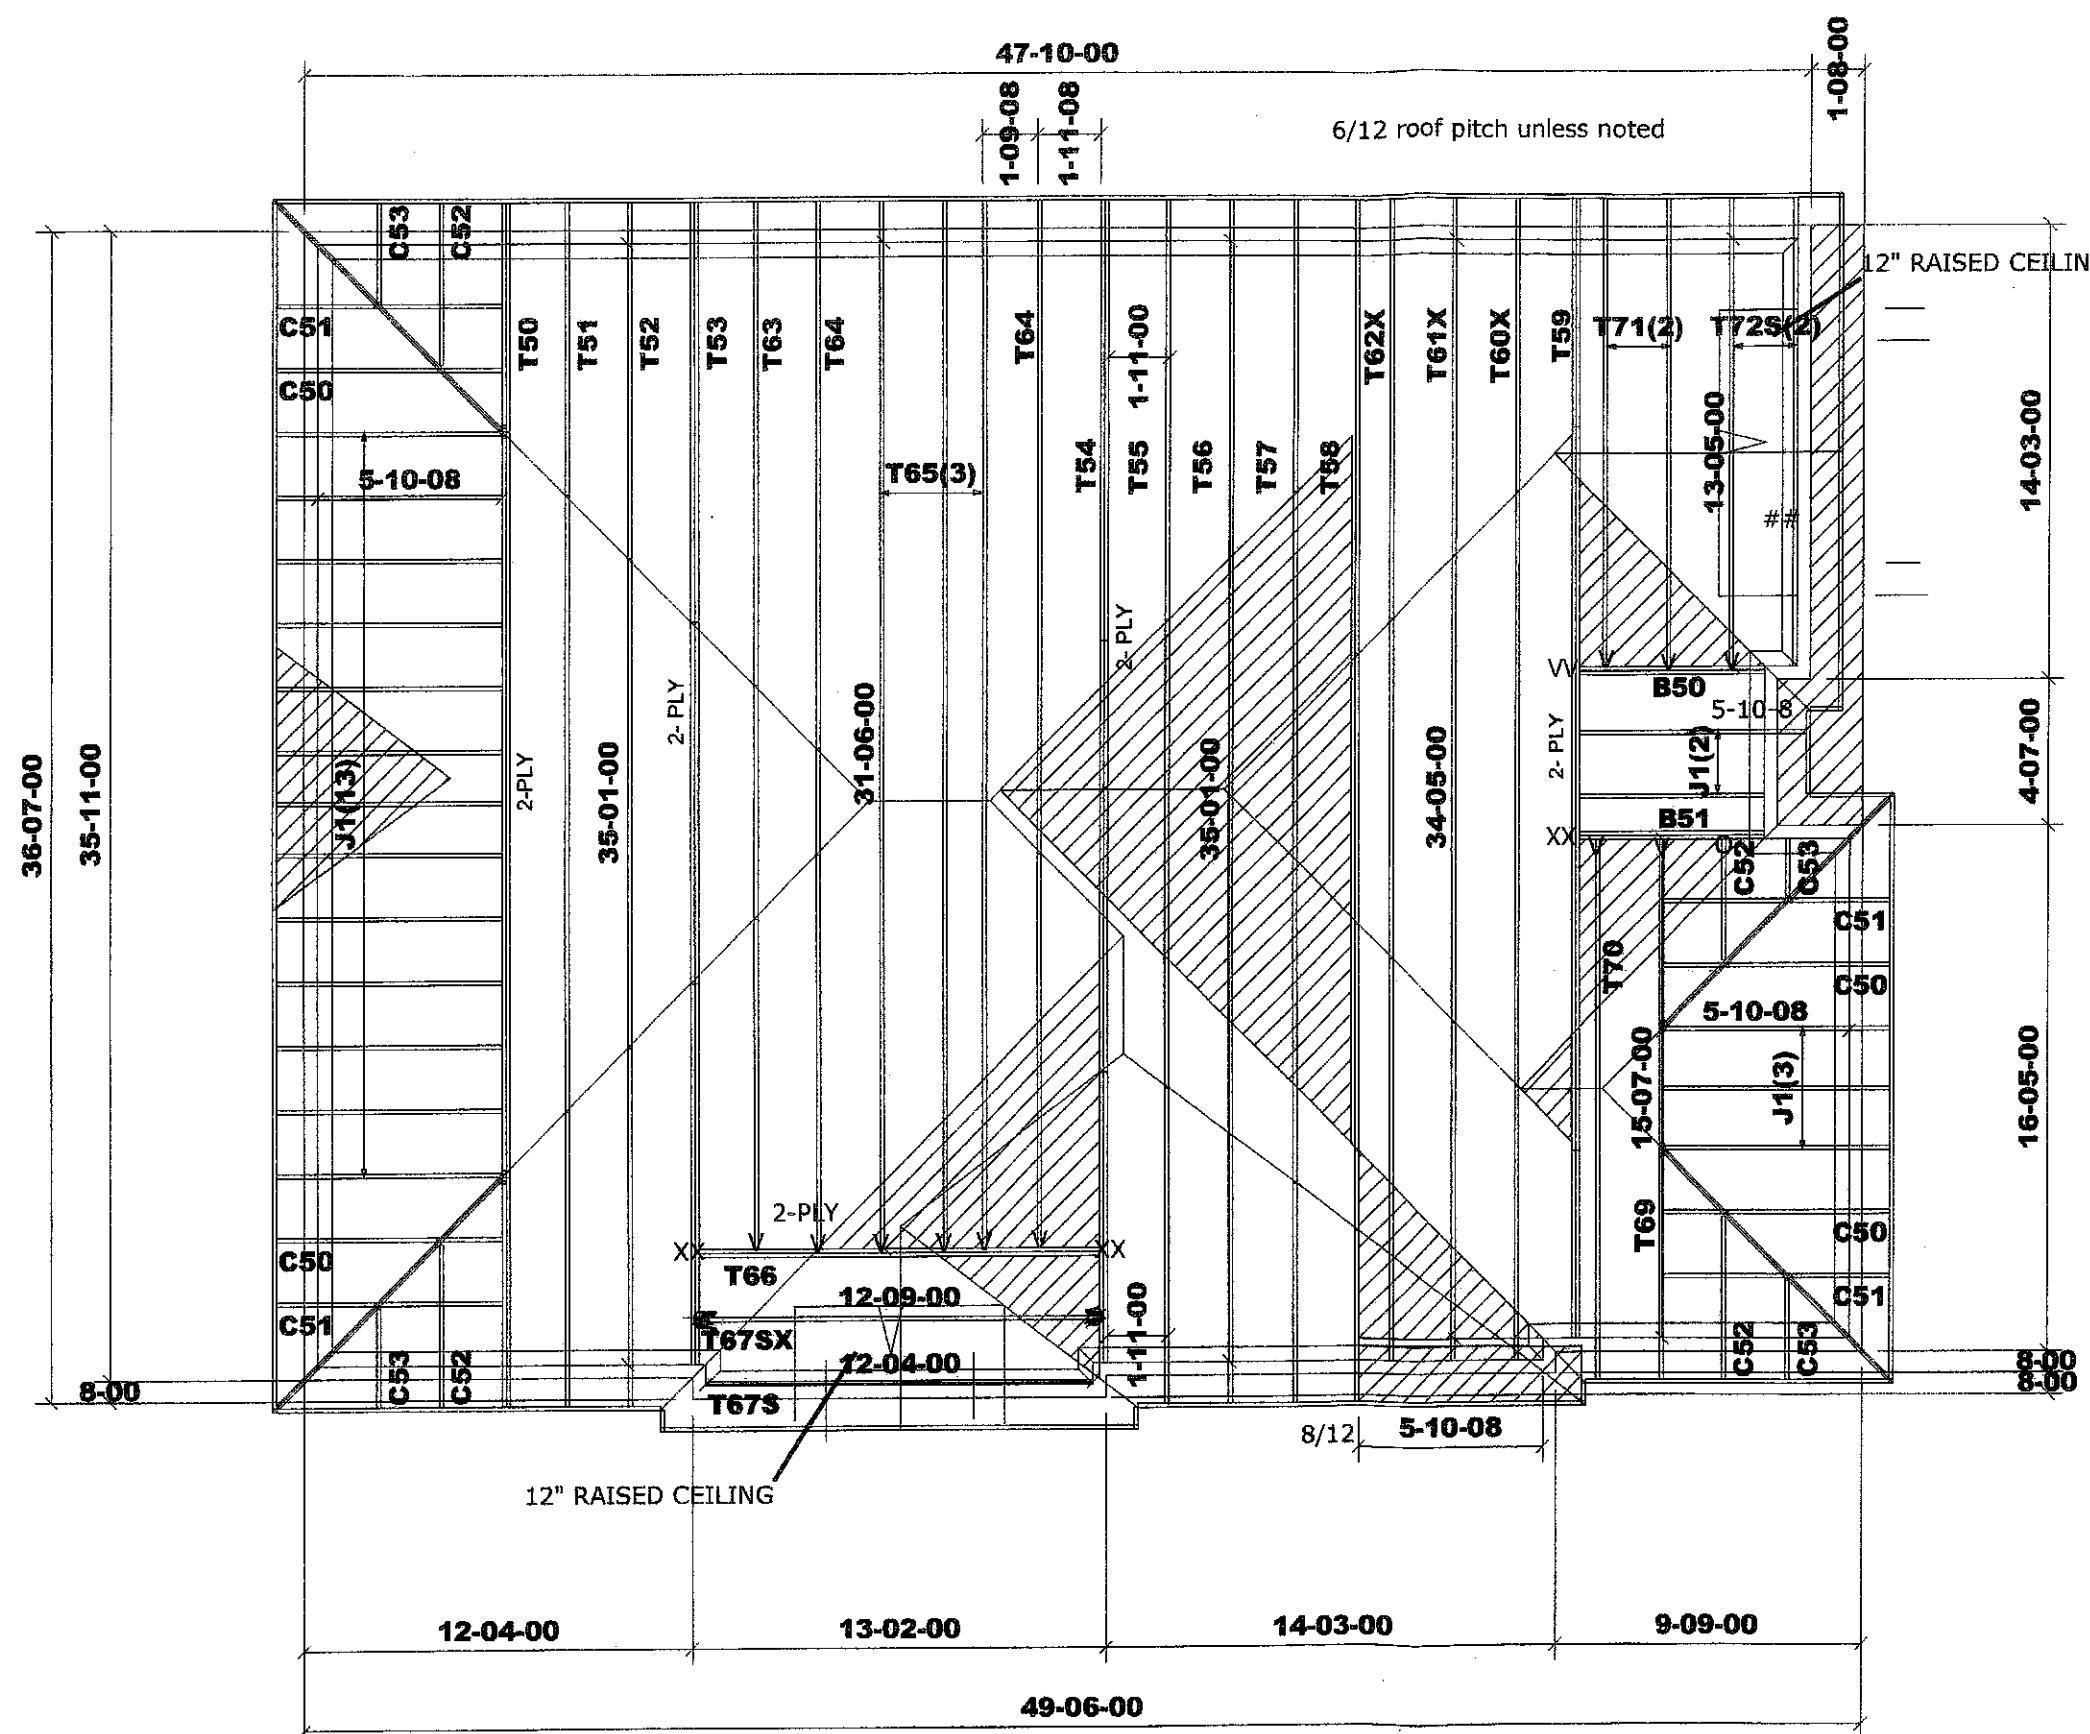

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.


All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.


DESIGN CONFORMS WITH OBC 2012
(2019 amendment) OCCUPANCY:
RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
HGUS26-2 - (XX)
LJS26DS - (V)
LUS24 - (O)
LUS26-2-(VV)

BEAMS:
B50= B51 =
2 - 2x10 SPF #2

 **DENOTES:**
CONVENTIONAL
FRAMING



Job Track: **51225**
Plan Log: **202439**
Layout ID: **408317**

Builder / Location:
GREEN PARK HOMES / WATERDOWN
Project: **RUSSELL GARDENS PH.3**
Date: 2020-04-30 Sales: **Mario DiCano** Designer: **JG**

Model / Elevation:
MOUNTAINASH 12/3

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.




DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 12
 Lot #:
 Elevation: 1

Job Track: 51225
 PlanLog: 202439
 Layout ID: 408315
 Ref #
 Page: 1 of 3
 Date: 04-29-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	8 / 12	35-01-00	5-03-13	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	350.17 212.00		
	1	T2 Hip	8 / 12	35-01-00	6-07-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	150.61 96.17		
	1	T3 Hip	8 / 12	35-01-00	7-11-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	157.43 98.33		
	1 3-ply	T4 Hip Girder	8 / 12	35-01-00	9-03-15	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	637.96 389.00		
	6	T5 Hip	8 / 12	28-10-00	10-07-13	2 x 4	1-03-08	1-04-13 5-06-13	945.96 588.00		
	1	T6 Hip	8 / 12	28-10-00	7-01-13	2 x 4	1-03-08	1-04-13 5-01-08	134.72 84.67		
	1	T7 Hip	8 / 12	28-10-00	8-05-13	2 x 4	1-03-08	1-04-13 5-01-08	139.02 86.50		
	1	T8 Hip	8 / 12	28-10-00	9-09-13	2 x 4	1-03-08	1-04-13 5-01-08	152.74 95.50		
	4	T9 Hip	8 / 12	28-10-00	11-01-13	2 x 4	1-03-08	1-04-13 5-01-08	604.67 375.33		
	1 2-ply	T10 Hip Girder	8 / 12	34-05-00	5-03-13	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	356.89 218.00		
	1 3-ply	T11 Hip Girder	8 / 12	34-05-00	5-09-15	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	574.26 357.00		
	1 2-ply	T12 Piggyback Base Girder	8 / 12	26-09-00	10-00-00	2 x 6		3-01-02 3-01-02	368.54 232.00		
	1	T13 Piggyback Base	8 / 12	26-09-00	10-00-00	2 x 4		3-01-02 3-01-02	131.75 82.33		
	1	T14S Piggyback Base	8 / 12	26-09-00	10-00-00	2 x 4		3-01-02 3-01-02	136.95 88.17		

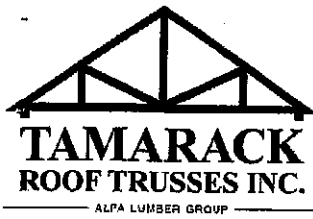

DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 12
 Lot #:
 Elevation: 1

Job Track: 51225
 PlanLog: 202439
 Layout ID: 408315
 Ref #
 Page: 2 of 3
 Date: 04-29-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	G15 GABLE	8 /12	26-07-00	10-03-02	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	131.86 84.33		
	1	T16 Common	8 /12	12-04-00	5-06-02	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	54.25 34.83		
	1	G16 GABLE	8 /12	12-04-00	5-06-02	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	53.94 35.83		
	2	T17 Common	8 /12	21-00-00	8-04-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	190.54 118.67		
	1	G17 GABLE	8 /12	21-00-00	8-04-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	98.26 83.00		
	3	T18 Common	8 /12	13-05-00	5-10-08	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	174.92 111.00		
	1	G18 GABLE	8 /12	13-05-00	5-10-08	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	58.93 37.00		
	3	T19 Common	8 /12	15-07-00	6-07-02	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	199.36 126.00		
	2	T20S Roof Special	8 /12 5 /12	15-07-00	6-07-02	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	132.03 90.87		
	1	T21 Hip Girder	0 /12	14-11-00	1-08-12	2 x 4		1-03-04 1-03-04	50.44 30.50		
	1	PB1 Piggyback	8 /12	7-04-00	1-04-00	2 x 4			19.39 13.17		
	4	PB2 Piggyback	8 /12	7-04-00	2-05-05	2 x 4			72.32 46.67		
	1	PB3 Piggyback	8 /12	5-02-00	1-04-00	2 x 4			12.02 9.00		
	2	PB4 Piggyback	8 /12	5-02-00	1-08-11	2 x 4			24.1 17.00		

		DELIVERY SHIPLIST	
TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: MOUNTAINASH 12 Lot #: Elevation: 1	Job Track: 51225 PlanLog: 202439 Layout ID: 408315 Ref # Page: 3 of 3 Date: 04-29-2020 Designer: Sales Rep: Mario DiCano	

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	PB5 Piggyback	8 /12	6-00-07	2-00-02	2 x 4			28.94 19.33		
	1 2-ply	PB5Z Piggyback	8 /12	6-00-07	2-00-02	2 x 4			28.94 19.33		
	6	J1 Jack-Open	8 /12	5-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	115.14 70.00		
	8	J2 Jack-Open	4 /12	3-08-08	1-11-11	2 x 4	1-03-08	3-15 1-06-12	82.8 53.33		
	1	C1 Jack-Open	8 /12	3-10-15	4-00-02	2 x 4	1-03-08 1-11-09	1-04-13 4-00-02	16.5 10.33		
	1	C2 Jack-Open	8 /12	1-10-15	2-08-02	2 x 4	1-03-08 3-11-09	1-04-13 2-08-02	13.73 9.00		
	1	C3 Jack-Open	8 /12	2-00-00	4-00-02	2 x 4	1-03-08 1-10-15	1-04-13 2-08-13	12.31 7.67		
	1	C4 Jack-Open	8 /12	1-10-15	2-08-02	2 x 4	1-03-08 1-01	1-04-13 2-08-02	9.57 6.33		

TOTAL # TRUSS= 75


TOTAL BFT OF ALL TRUSSES= 4015.99 BFT.

TOTAL WEIGHT OF ALL TRSSES 6422.08 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
2	Hardware	HGUS26-2	
25	Hardware	LJS26DS	
1	Hardware	LUS26-2	
2		THGQ2-SDS3(MAX)	

TOTAL NUMBER OF
ITEMS= 30

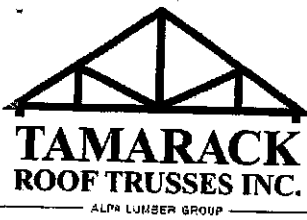

DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 12
 Lot #:
 Elevation: 2


Job Track: 51225
 PlanLog: 202439
 Layout ID: 408316
 Ref #
 Page: 1 of 3
 Date: 04-29-2020
 Designer:
 Sales Rep: Mario DiCano


Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T100 Hip Girder	8 /12	35-01-00	5-03-13	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	327.59 201.00		
	1	T2 Hip	8 /12	35-01-00	6-07-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	150.81 96.17		
	1	T3 Hip	8 /12	35-01-00	7-11-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	157.43 98.33		
	1	T18 Common	8 /12	13-05-00	5-10-08	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	58.32 37.00		
	2	T18S Roof Special	8 /12 5 /12	13-05-00	5-10-08	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	114.8 74.00		
	2	T19 Common	8 /12	15-07-00	6-07-02	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	132.91 84.00		
	2	T20S1 Roof Special	8 /12 5 /12	15-07-00	6-07-02	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	131.62 86.33		
	1 2-ply	T30 Hip Girder	8 /12	35-01-00	9-03-15	2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	437.22 265.00		
	1 2-ply	T31 Roof Special Girder	8 /12	35-01-00	9-09-02	2 x 4 2 x 6	1-03-08	1-04-13 1-07-10	377.44 230.67		
	1	T32 Roof Special	8 /12	35-01-00	10-11-02	2 x 4	1-03-08 1-03-08	1-04-13 1-07-10	187.9 115.67		
	1	T33 Roof Special	8 /12	35-01-00	9-08-13	2 x 4	1-03-08 1-03-08	1-04-13 1-07-10	169.56 106.50		
	1 2-ply	T34 Roof Special Girder	8 /12	35-01-00	8-04-13	2 x 4 2 x 6	1-03-08	1-04-13 1-07-10	389.66 228.33		
	1 2-ply	T35 Hip Girder	8 /12	34-05-00	4-04-13	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	348.56 217.33		
	6	T36 Hip	8 /12	31-06-00	10-07-13	2 x 4	1-03-08	1-04-13 3-09-08	984.11 610.00		

 TAMARACK ROOF TRUSSES INC. ALFA LUMBER GROUP	DELIVERY SHIPLIST				Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: MOUNTAINASH 12 Lot #: Elevation: 2		Job Track: 51225 Plan Log: 202439 Layout ID: 408316 Ref # Page: 2 of 3 Date: 04-29-2020 Designer: Sales Rep: Mario DiCano	

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T37 Hip	8 /12	31-06-00	5-08-13	2 x 4	1-03-08	1-04-13 3-04-02	129.05 81.67		
	1	T38 Hip	8 /12	31-06-00	7-00-13	2 x 4	1-03-08	1-04-13 3-04-02	139.38 87.17		
	1	T39 Hip	8 /12	31-06-00	8-04-13	2 x 4	1-03-08	1-04-13 3-04-02	148.29 92.67		
	1	T40 Hip	8 /12	31-06-00	9-08-13	2 x 4	1-03-08	1-04-13 3-04-02	168.47 99.67		
	1	T41 Hip	8 /12	31-06-00	11-00-13	2 x 4	1-03-08	1-04-13 3-04-02	155.42 96.50		
	1 2-ply	T42 Common Girder	8 /12	12-09-00	5-06-02	2 x 4 2 x 6		1-03-02 1-03-02	128.29 78.67		
	1	T43S Roof Special	8 /12 5 /12	12-04-00	5-06-02	2 x 4		1-04-13 1-04-13	50.13 32.67		
	1	T43SX Roof Special	8 /12 5 /12	12-09-00	5-06-02	2 x 4		1-03-02 1-03-02	51.43 33.67		
	1 2-ply	T44 Common Girder	8 /12	10-06-00	4-10-13	2 x 4		1-04-13 1-04-13	93.02 60.00		
	1	T45 Common	8 /12	10-06-00	4-10-13	2 x 4		1-04-13 1-04-13	40.51 25.50		
	1	T45S Roof Special	8 /12 5 /12	10-06-00	4-10-13	2 x 4		1-04-13 1-04-13	43.88 29.00		
	1	PB1 Piggyback	8 /12	7-04-00	1-04-00	2 x 4			19.39 13.17		
	4	PB2 Piggyback	8 /12	7-04-00	2-05-05	2 x 4			72.32 46.67		
	1	V30 Valley	8 /12	12-03-00	4-01-00	2 x 4			35.76 23.00		

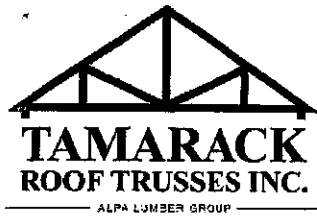

DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 12
 Lot #:
 Elevation: 2

Job Track: 51225
 PlanLog: 202439
 Layout ID: 408316
 Ref #
 Page: 3 of 3
 Date: 04-29-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	V31 Valley	8 /12	8-03-00	2-09-00	2 x 4			21.09 14.17		
	13	J1 Jack-Open	8 /12	5-10-08	5-03-13	2 x 4	1-05-00	1-04-13 5-03-13	251.71 151.67		
	2	J30 Jack-Open	8 /12	4-06-00	4-04-13	2 x 4	1-03-08	1-04-13 4-04-13	31.48 20.67		
	2	C1 Jack-Open	8 /12	3-10-15	4-00-02	2 x 4	1-03-08 1-11-09	1-04-13 4-00-02	33 20.67		
	2	C2 Jack-Open	8 /12	1-10-15	2-08-02	2 x 4	1-03-08 3-11-09	1-04-13 2-08-02	27.45 18.00		
	2	C3 Jack-Open	8 /12	2-00-00	4-00-02	2 x 4	1-03-08 1-10-15	1-04-13 2-08-13	24.63 15.33		
	2	C4 Jack-Open	8 /12	1-10-15	2-08-02	2 x 4	1-03-08 1-01	1-04-13 2-08-02	19.15 12.67		

TOTAL # TRUSS= 70

TOTAL BFT OF ALL TRUSSES= 3503.54


BFT.

TOTAL WEIGHT OF ALL TRSSES 5621.57 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
4	Hardware	HGUS26-2	
15	Hardware	LJS26DS	
4	Hardware	LUS24	
2	Hardware	LUS26-2	

TOTAL NUMBER OF
ITEMS= 25



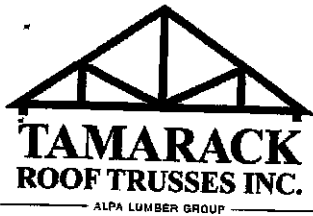


DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 12
 Lot #:
 Elevation: 3





Job Track: 51225
 PlanLog: 202439
 Layout ID: 408317
 Ref #
 Page: 1 of 3
 Date: 04-30-2020
 Designer:
 Sales Rep: Mario DiCano


Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T50 Hip Girder	6 /12	35-01-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	308 192.00		
	1	T51 Hip	6 /12	35-01-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	138.75 87.00		
	1	T52 Hip	6 /12	35-01-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	138.32 87.33		
	1 2-ply	T53 Hip Girder	6 /12	35-01-00	7-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	354.2 219.00		
	1 2-ply	T54 Roof Special Girder	6 /12	35-01-00	7-05-04	2 x 4 2 x 6	1-03-08	1-02-00 1-04-13	342.81 208.33		
	1	T55 Roof Special	6 /12	35-01-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-04-13	144.8 90.50		
	1	T56 Roof Special	6 /12	35-01-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-04-13	144.65 90.50		
	1	T57 Roof Special	6 /12	35-01-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-04-13	142.13 88.67		
	1	T58 Roof Special	6 /12	35-01-00	7-07-12	2 x 4	1-03-08 1-03-08	1-02-00 1-04-13	155.1 99.67		
	1 2-ply	T59 Hip Girder	6 /12	34-05-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	335 210.00		
	1	T60X Hip	6 /12	35-01-00	5-01-04	2 x 4	1-03-08	1-02-00 10-00	138.56 86.83		
	1	T61X Hip	6 /12	35-01-00	6-01-04	2 x 4	1-03-08	1-02-00 10-00	137.06 84.83		
	1	T62X Hip	6 /12	35-01-00	7-01-04	2 x 4	1-03-08	1-02-00 10-00	143.34 89.50		
	1	T63 Hip	6 /12	31-06-00	8-01-04	2 x 4	1-03-08	1-02-00 2-11-08	134.66 84.83		

 TAMARACK ROOF TRUSSES INC. ALFA LUMBER GROUP	DELIVERY SHIPLIST				Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: MOUNTAINASH 12 Lot #: Elevation: 3		Job Track: 51225 PlanLog: 202439 Layout ID: 408317 Ref # Page: 2 of 3 Date: 04-30-2020 Designer: Sales Rep: Mario DiCano	
---	-------------------	--	--	--	--	--	---	--

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	T64 Hip	6 /12	31-06-00	9-01-04	2 x 4	1-03-08	1-02-00 2-11-08	284.64 180.00		
	3	T65 Common	6 /12	31-06-00	9-11-04	2 x 4	1-03-08	1-02-00 2-11-08	412.8 259.00		
	1 2-ply	T66 Common Girder	6 /12	12-09-00	4-03-00	2 x 4 2 x 6		1-00-12 1-00-12	117.89 78.00		
	1	T67S Roof Special	6 /12	12-04-00	4-03-00	2 x 4		1-02-00 1-02-00	51.59 34.83		
	1	T67SX Roof Special	6 /12	12-09-00	4-03-00	2 x 4		1-00-12 1-00-12	53.05 36.17		
	1	T69 Hip Girder	6 /12	15-07-00	4-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	61.23 39.17		
	1	T70 Common	6 /12	15-07-00	5-00-12	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	61.14 39.17		
	2	T71 Common	6 /12	13-05-00	4-06-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	108.99 68.00		
	2	T72S Roof Special	6 /12	13-05-00	4-06-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	113.78 75.67		
	18	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	302.3 192.00		
	4	C50 Jack-Open	6 /12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	56.53 34.67		
	4	C51 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	46.33 29.33		
	4	C52 Jack-Open	6 /12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	38.28 24.00		
	4	C53 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	28.08 18.67		

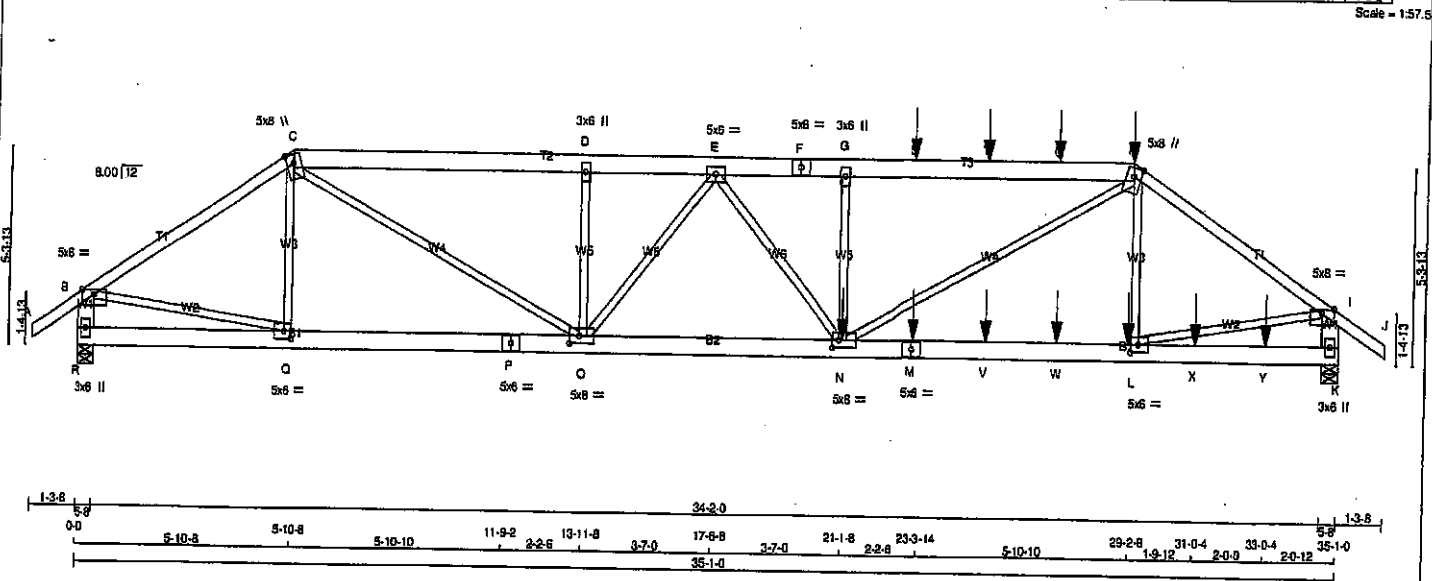

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - F	2x6	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - J	2x4	DRY	No.2	SPF
J - B	2x4	DRY	No.2	SPF
B - I	2x6	DRY	No.2	SPF
I - P	2x6	DRY	No.2	SPF
P - M	2x6	DRY	No.2	SPF
M - K	2x6	DRY	No.2	SPF
K - K	2x6	DRY	No.2	SPF

ALC WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY, SEASONED LUMBER.
DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C 1	12	TOP
H-J 1	12	SIDE(183.1)
C-F 2	12	TOP
F-H 2	12	SIDE(183.1)
R-B 2	12	TOP
K-I 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
R-P 2	12	TOP
P-M 2	12	SIDE(183.1)
M-K 2	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
L-H 1	6	SIDE(18.3)
N-G 1	6	SIDE(240.7)
2x3 1	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.
GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.
TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	2990	0	0
R	2990	0	0
K	4041	0	0

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS
COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
JT	2109 1413 / 0 0 / 0 0 / 0 696 / 0 0 / 0
R	2853 1899 / 0 0 / 0 0 / 0 853 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.84 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1 MAX (PLF)	MEMB.	FORCE (LBS)
FR-TO			FR-TO	
A-B	0 / 35	-91.8 -91.8 0.07 (1)	Q-C	-371 / 0 0.07 (1)
B-C	-3676 / 0	-91.8 -91.8 0.45 (1)	C-O	0 / 3550 0.44 (1)
C-D	-6111 / 0	-91.8 -91.8 0.30 (1)	N-H	0 / 3802 0.47 (1)
D-E	-6111 / 0	-91.8 -91.8 0.29 (1)	L-H	-434 / 84 0.09 (1)
E-F	-7562 / 0	-91.8 -91.8 0.41 (1)	B-Q	0 / 3110 0.38 (1)
F-G	-7562 / 0	-91.8 -91.8 0.41 (1)	L-I	0 / 4363 0.54 (1)
G-S	-7563 / 0	-91.8 -91.8 0.59 (1)	O-D	-798 / 0 0.15 (1)
S-T	-7563 / 0	-91.8 -91.8 0.59 (1)	N-G	-1225 / 0 0.23 (1)
T-U	-7563 / 0	-91.8 -91.8 0.56 (1)	O-E	-1131 / 0 0.35 (1)
U-H	-7563 / 0	-91.8 -91.8 0.56 (1)	E-N	0 / 1314 0.19 (1)
H-I	-5157 / 0	-91.8 -91.8 0.56 (1)		
I-J	0 / 35	-91.8 -91.8 0.07 (1)		
R-B	-2954 / 0	0.0 0.0 0.11 (1)		
K-I	-3895 / 0	0.0 0.0 0.14 (1)		

FR-TO	LOC	LC1	MAX	MAX	FACE	DIR.	TYPE	HEEL	CONN.
JT	29-2-8	-538	-838		FRONT	VERT	TOTAL		C1
L	29-1-12	-36	-36		FRONT	VERT	TOTAL		C1
M	23-1-12	-36	-36		FRONT	VERT	TOTAL		C1
N	21-1-8	-1824	-1824		FRONT	VERT	TOTAL		C1
S	23-1-12	-178	-178		FRONT	VERT	TOTAL		C1
T	25-1-12	-178	-178		FRONT	VERT	TOTAL		C1
U	27-1-12	-178	-178		FRONT	VERT	TOTAL		C1
V	25-1-12	-36	-36		FRONT	VERT	TOTAL		C1
W	27-1-12	-36	-36		FRONT	VERT	TOTAL		C1
X	31-0-4	-36	-36		FRONT	VERT	TOTAL		C1
Y	33-0-4	-36	-36		FRONT	VERT	TOTAL		C1

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC	LC1	MAX	MAX	FACE	DIR.	TYPE	HEEL	CONN.
H	29-2-8	-538	-838		FRONT	VERT	TOTAL		C1
L	29-1-12	-36	-36		FRONT	VERT	TOTAL		C1
M	23-1-12	-36	-36		FRONT	VERT	TOTAL		C1
N	21-1-8	-1824	-1824		FRONT	VERT	TOTAL		C1
S	23-1-12	-178	-178		FRONT	VERT	TOTAL		C1
T	25-1-12	-178	-178		FRONT	VERT	TOTAL		C1
U	27-1-12	-178	-178		FRONT	VERT	TOTAL		C1
V	25-1-12	-36	-36		FRONT	VERT	TOTAL		C1
W	27-1-12	-36	-36		FRONT	VERT	TOTAL		C1
X	31-0-4	-36	-36		FRONT	VERT	TOTAL		C1
Y	33-0-4	-36	-36		FRONT	VERT	TOTAL		C1

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.17")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.30")

CSI: TC=0.58/1.00 (H-I), SC=0.48/1.00 (N-D-I),
WB=0.54/1.00 (L-I), SS=0.25/1.00 (G-H-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1697 788 1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (L) (INPUT = 0.80)
JSI METAL= 0.54 (L) (INPUT = 1.00)



Structural component only
DWG# T-2008005 1/2

JOB NAME 408315	TRUSS NAME T1	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 09:31:32 2020 Page 2
ID:DMCubINVR6TstFoe31v6I zns1F-VsUaKwFKIBus9rtCMOYrO00NF3whfGAeBZc9OzLaf9

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TTWW-m	MT20	5.0	8.0	Edge	
D	TMW+w	MT20	3.0	8.0		
E	TMWW-t	MT20	5.0	8.0		
F	TS-t	MT20	5.0	8.0		
G	TMW+w	MT20	3.0	8.0		
H	TTWW-m	MT20	5.0	8.0	Edge	
I	TMVW-p	MT20	5.0	8.0	Edge	
K	BMV1+p	MT20	3.0	6.0		
L	BMWW-t	MT20	5.0	8.0	2.50	2.50
M	BS-t	MT20	5.0	8.0		
N	BMWW-t	MT20	5.0	8.0	2.50	2.25
O	BMWW-t	MT20	5.0	8.0	2.50	3.25
P	BS-t	MT20	5.0	8.0		
Q	BMWW-t	MT20	5.0	8.0	2.50	2.50
R	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2008005 4/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408316	T100	1	2	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 M Tek Industries, Inc. Thu Apr 30 10:05:38 2020 Page 1
ID:DMCubINVR6TsFoe31v61_zns1HbU63fW0JTqgZdH85325Lmslax0Me479K7VA1zqzLa9B

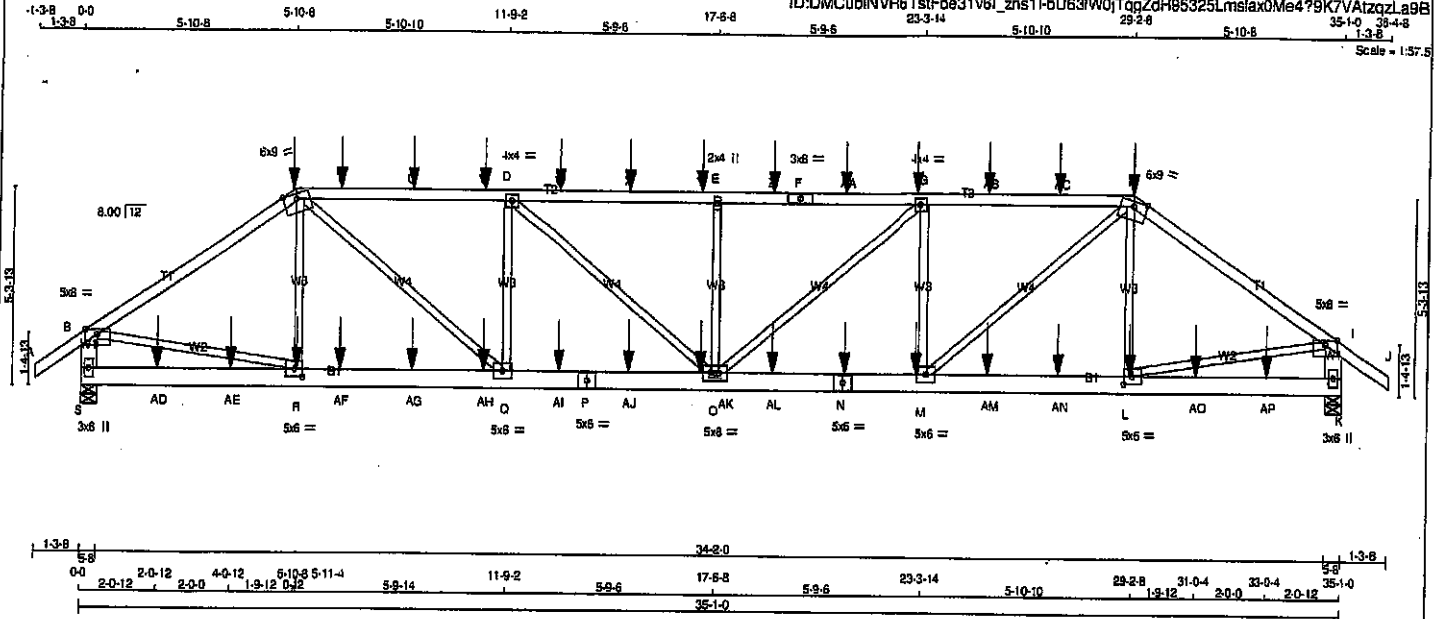

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				TOTAL WEIGHT = 2 X 164 = 328 lb			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD	DESIGN CRITERIA	
A - C	2x4	DRY	No.2	SPF	GROSS REACTION	DOWN	GROSS REACTION	UP	BRG	SPECIFIED LOADS:	
C - F	2x4	DRY	No.2	SPF	VERT	0	3909	0	5-8	TOP CH. LL = 25.8 PSF	
F - H	2x4	DRY	No.2	SPF	HORIZ	0	3909	0	5-8	DL = 6.0 PSF	
H - J	2x4	DRY	No.2	SPF						BOT CH. LL = 0.0 PSF	
S - B	2x6	DRY	No.2	SPF						DL = 7.4 PSF	
K - I	2x6	DRY	No.2	SPF						TOTAL LOAD = 39.0 PSF	
S - P	2x6	DRY	No.2	SPF						SPACING = 24.0 IN/C	
P - N	2x6	DRY	No.2	SPF						LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12	
N - K	2x6	DRY	No.2	SPF						THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF						THIS DESIGN COMPLIES WITH:	
DRY: SEASONED LUMBER.										- PART 9 OF NBC 2010, NBC 2015	
DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:										- PART 9 OF NBC 2012 (2019 AMENDMENT)	
CHORDS #ROWS SURFACE SPACING (IN) LOAD(PLF)										- CSA 088-09, CSA 088-14	
TOP CHORDS : (0.122"x3") SPIRAL NAILS										- TPIC 2011, TPIC 2014	
A-C 1 12 SIDE(61.0)										(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD	
C-F 1 12 SIDE(61.0)										ALLOWABLE DEFL.(LL) = L/360 (1.17")	
F-H 1 12 SIDE(61.0)										CALCULATED VERT. DEFL.(LL) = L/988 (0.19")	
H-J 1 12 SIDE(61.0)										ALLOWABLE DEFL.(TL) = L/360 (1.17")	
S-B 2 12 TOP SIDE(183.1)										CALCULATED VERT. DEFL.(TL) = L/999 (0.35")	
K-I 2 12 TOP SIDE(183.1)										CSI: TC=0.89/1.00 (D-E:1), BC=0.48/1.00 (O-Q:1), WB=0.52/1.00 (R-R:1), SS=0.29/1.00 (C-D:1)	
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS										DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.00	
S-P 2 12 SIDE(183.1)										COMP=1.00 SHEAR=1.00 TENS=1.00	
P-N 2 12 SIDE(183.1)										COMPANION LIVE LOAD FACTOR = 1.00	
N-K 2 12 TOP SIDE(183.1)										AUTOSOLVE HEELS OFF	
WEBS : (0.122"x3") SPIRAL NAILS										TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.	
R-C 1 6 SIDE(19.3)										NAIL VALUES	
L-H 1 6 SIDE(19.3)										PLATE GRIP(DRY) SHEAR SECTION	
2x3 1 6 SIDE(19.3)										(PSI) (PLI) (PLI)	
NAILS TO BE DRIVEN FROM ONE SIDE ONLY.										MAX MIN MAX MIN MAX MIN	
GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.										MT20 618 354 1687 798 1987 1656	
TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLYS FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.										PLATE PLACEMENT TOL. = 0.250 inches	
										PLATE ROTATION TOL. = 5.0 Deg.	
										JSI GRIP= 0.88 (R) (INPUT = 0.80)	
										JSI METAL= 0.61 (P) (INPUT = 1.00)	
										STRUCTURAL COMPONENT ONLY	
										DWG# T-2008047	

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408316	T100	1	2	GREEN PARK HOMES		

Yamack Road Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:05:38 2020 Page 2
ID:DMCubINVR6TstFoe31v6f zns1t-bU63W0ITggZdH95325Lmslax0Me479K7VAtzqzLa9B

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TTWW-m	MT20	8.0	9.0	Edge	
D	TMWW-l	MT20	4.0	4.0		
E	TMW-w	MT20	2.0	4.0		
F	TS-l	MT20	3.0	8.0		
G	TMWW-t	MT20	4.0	4.0		
H	TTWW-m	MT20	8.0	9.0	Edge	
I	TMVW-p	MT20	5.0	8.0	Edge	
K	BMV1-p	MT20	3.0	6.0		
L	BMWW-l	MT20	5.0	6.0	2.50	2.75
M	BMWW-l	MT20	5.0	6.0		
N	BS-l	MT20	5.0	6.0		
O	BMWW-l	MT20	5.0	6.0		
P	BS-l	MT20	5.0	6.0		
Q	BMWW-l	MT20	5.0	6.0		
R	BMWW-l	MT20	5.0	6.0	2.50	2.75
S	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-542	-542		FRONT	VERT	TOTAL		C1
G	23-1-12	-178	-178		FRONT	VERT	TOTAL		C1
H	29-2-8	-542	-542		FRONT	VERT	TOTAL		C1
L	29-1-12	-36	-36		FRONT	VERT	TOTAL		C1
M	23-1-12	-36	-36		FRONT	VERT	TOTAL		C1
N	21-1-12	-36	-36		FRONT	VERT	TOTAL		C1
R	5-11-4	-36	-36		FRONT	VERT	TOTAL		C1
T	7-1-12	-178	-178		FRONT	VERT	TOTAL		C1
U	9-1-12	-178	-178		FRONT	VERT	TOTAL		C1
V	11-1-12	-178	-178		FRONT	VERT	TOTAL		C1
W	13-1-12	-178	-178		FRONT	VERT	TOTAL		C1
X	15-1-12	-178	-178		FRONT	VERT	TOTAL		C1
Y	17-1-12	-178	-178		FRONT	VERT	TOTAL		C1
Z	19-1-12	-178	-178		FRONT	VERT	TOTAL		C1
AA	21-1-12	-178	-178		FRONT	VERT	TOTAL		C1
AB	25-1-12	-178	-178		FRONT	VERT	TOTAL		C1
AC	27-1-12	-178	-178		FRONT	VERT	TOTAL		C1
AD	2-0-12	-36	-36		FRONT	VERT	TOTAL		C1
AE	4-0-12	-36	-36		FRONT	VERT	TOTAL		C1
AF	7-1-12	-36	-36		FRONT	VERT	TOTAL		C1
AG	9-1-12	-36	-36		FRONT	VERT	TOTAL		C1
AH	11-1-12	-36	-36		FRONT	VERT	TOTAL		C1
AI	13-1-12	-36	-36		FRONT	VERT	TOTAL		C1
AJ	15-1-12	-36	-36		FRONT	VERT	TOTAL		C1
AK	17-1-12	-36	-36		FRONT	VERT	TOTAL		C1
AL	19-1-12	-36	-36		FRONT	VERT	TOTAL		C1
AM	25-1-12	-36	-36		FRONT	VERT	TOTAL		C1
AN	27-1-12	-36	-36		FRONT	VERT	TOTAL		C1
AO	31-0-4	-36	-36		FRONT	VERT	TOTAL		C1
AP	33-0-4	-36	-36		FRONT	VERT	TOTAL		C1

CONNECTION REQUIREMENTS


- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2008047 3/2

JOB NAME 408315	TRUSS NAME T2	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:33 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-z32zYGGy3V0n?K3m3vnNcZ7IP7Q1YK1r19iszLa78
20-8-12 27-2-8 31-0-8 35-1-0 35-4-8
6-5-12 6-5-12 3-10-0 1-8-8 1-3-8
Scale = 1:57.5

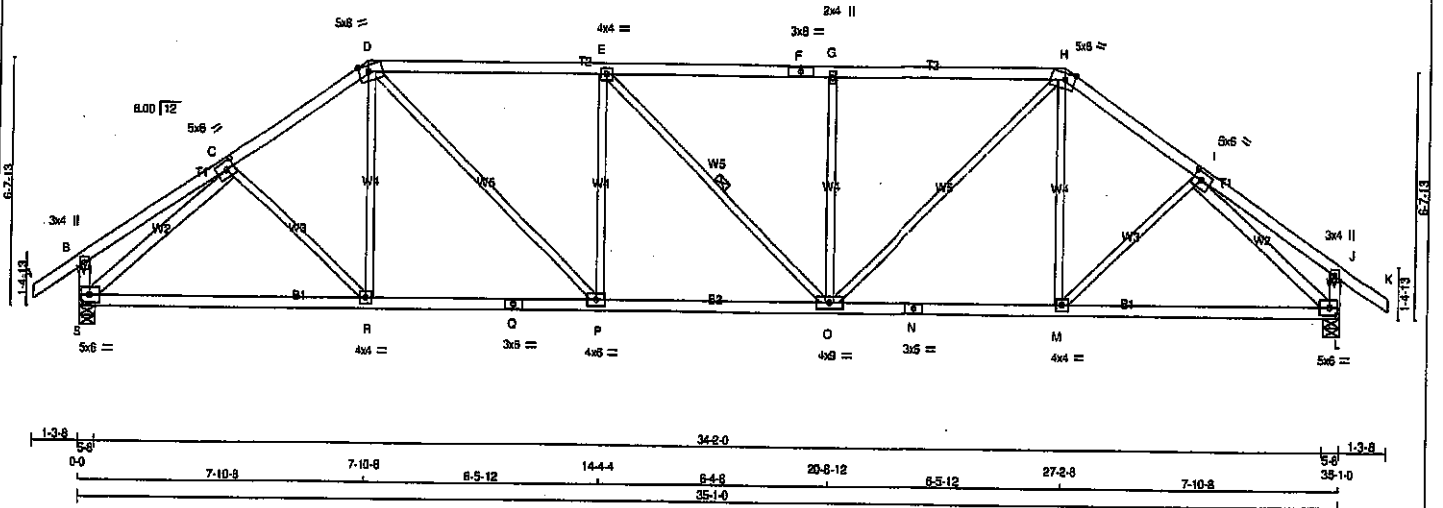

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4 DRY	No.2		
D - F	2x4 DRY	No.2		
F - H	2x4 DRY	No.2		
H - K	2x4 DRY	No.2		
S - B	2x4 DRY	No.2		
L - J	2x4 DRY	No.2		
S - Q	2x4 DRY	No.2		
Q - N	2x4 DRY	No.2		
N - L	2x4 DRY	No.2		
ALL WEBS EXCEPT S - C	2x3 DRY	No.2		
I - L	2x4 DRY	No.2		

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV-p	MT20	3.0	4.0		
C	TMVW-1	MT20	5.0	6.0	2.50	2.75
D	TTWW-m	MT20	5.0	8.0	2.00	3.25
E	TMVW-1	MT20	4.0	4.0		
F	TS-1	MT20	3.0	8.0		
G	TMVW-p	MT20	2.0	4.0		
H	TTWW-m	MT20	5.0	8.0	2.00	3.25
I	TMVW-1	MT20	5.0	6.0	2.50	2.75
J	TMV-p	MT20	3.0	4.0		
L	BMVW-1-1	MT20	5.0	6.0	2.50	2.75
M	BMVW-1	MT20	4.0	4.0		
N	BS-1	MT20	3.0	6.0		
O	BMVW-1	MT20	4.0	9.0		
P	BMVW-1	MT20	4.0	6.0		
Q	BS-1	MT20	3.0	6.0		
R	BMVW-1	MT20	4.0	4.0		
S	BMVW-1-1	MT20	5.0	6.0	2.50	2.75

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	DOWN	UP	IN-SX
S	2060	0	0	5-8
L	2060	0	0	5-8

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW
S	1454	988 / 0
L	1454	988 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO							
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	C-R	0 / 72
B-C	0 / 22	-91.8	-91.8	0.21 (1)	10.00	R-D	0 / 126
C-D	-2282 / 0	-91.8	-91.8	0.30 (1)	4.25	D-P	0 / 1071
D-E	-2844 / 0	-91.8	-91.8	0.78 (1)	3.47	P-E	-840 / 0
E-F	-2843 / 0	-91.8	-91.8	0.77 (1)	3.47	E-O	-2 / 0
F-G	-2843 / 0	-91.8	-91.8	0.77 (1)	3.47	O-G	-840 / 0
G-H	-2843 / 0	-91.8	-91.8	0.77 (1)	3.49	H-I	0 / 1089
H-I	-2282 / 0	-91.8	-91.8	0.30 (1)	4.25	I-M	0 / 126
I-J	0 / 22	-91.8	-91.8	0.21 (1)	10.00	M-I	0 / 72
J-K	0 / 35	-91.8	-91.8	0.12 (1)	10.00	S-C	-2527 / 0
S-B	-267 / 0	0.0	0.0	0.03 (1)	7.81	I-L	-2527 / 0
L-J	-267 / 0	0.0	0.0	0.03 (1)	7.81		
S-R	0 / 1840	-18.5	-18.5	0.44 (1)	10.00		
R-Q	0 / 1879	-18.5	-18.5	0.45 (1)	10.00		
C-P	0 / 1879	-18.5	-18.5	0.45 (1)	10.00		
P-O	0 / 2045	-18.5	-18.5	0.49 (1)	10.00		
O-N	0 / 1880	-18.5	-18.5	0.45 (1)	10.00		
N-M	0 / 1880	-18.5	-18.5	0.45 (1)	10.00		
M-L	0 / 1840	-18.5	-18.5	0.44 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:	TOP CH.	LL	DL	PSF
	25.6	6.0	0.0	0.0
SPECIFIED LOADS:	BOT CH.	LL	DL	PSF
	0.0	7.4	0.0	0.0
	39.0			

TOTAL WEIGHT = 151 lb

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, NBCC 2015
- PART 9 OF NBCC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)

CALCULATED VERT. DEFL.(LL) = L/999 (0.13)

ALLOWABLE DEFL.(TL) = L/360 (1.17)

CALCULATED VERT. DEFL.(TL) = L/999 (0.27)

CSI: TC=0.78/1.00 (D-E:1), SC=0.48/1.00 (O-P:1)

WB=0.88/1.00 (H-L:1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN


MT20 818 354 1667 788 1987 1655

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (1) (INPUT = 0.90)

JSI METAL= 0.83 (1) (INPUT = 1.00)

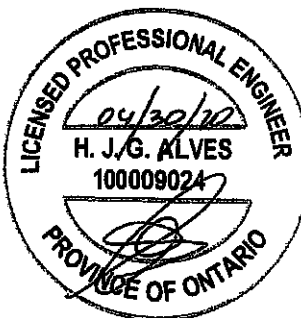

Structural component only
DWG# T-2008006

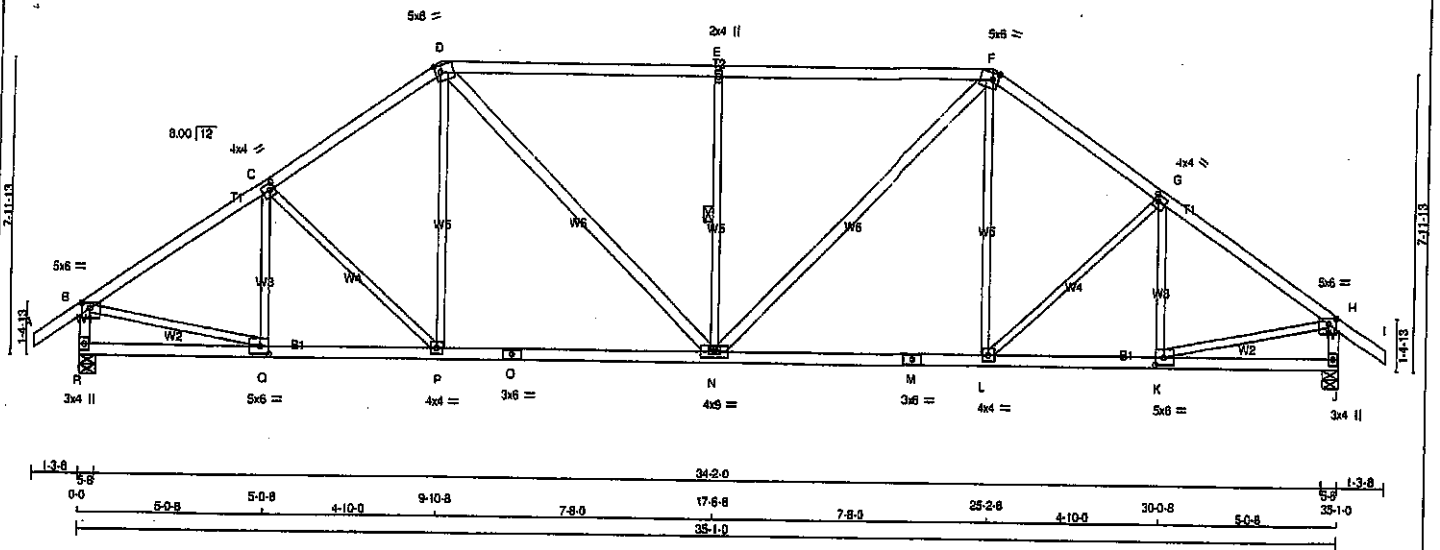

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				TOTAL WEIGHT = 157 lb			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	BEARINGS				DESIGN CRITERIA		
A - D	2x4	DRY	No.2	SPF	FACTORED	MAXIMUM FACTORED	INPUT	REQD	SPECIFIED LOADS:		
D - F	2x4	DRY	No.2	SPF	GROSS REACTION	GROSS REACTION	BRG	BRG	TOP CH. LL =	25.6	PSF
F - I	2x4	DRY	No.2	SPF	JT VERT	HORZ	DOWN	HORZ	DL =	6.0	PSF
R - B	2x4	DRY	No.2	SPF	R	2080	0	2080	0	0	PSF
J - H	2x4	DRY	No.2	SPF	J	2080	0	2080	0	0	PSF
R - O	2x4	DRY	No.2	SPF	UNFACTORED REACTIONS				TOTAL LOAD =		
O - M	2x4	DRY	No.2	SPF	1ST CASE	MAX / MIN	COMPONENT REACTIONS		SPACING =		
M - J	2x4	DRY	No.2	SPF	JT COMBINED	SNOW	LIVE	PERMALIVE	WIND	DEAD	SOIL
					R	1454	968 / 0	0 / 0	0 / 0	487 / 0	0 / 0
					J	1454	968 / 0	0 / 0	0 / 0	487 / 0	0 / 0
					BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J						
					BRACING						
					TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.38 FT.						
					MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.						
					ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.						
					1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.						
					END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW						
					LOADING						
					TOTAL LOAD CASES: (4)						
					CHORDS						
					MEMB.	FORCE	FACTORED	VERT. LOAD	LC1	MAX	W E B S
						(LBS)	(PLF)	CSI (LC)	UNBRAC	LENGTH	MEMB.
					FR-TO		FROM TO				FR-TO
					A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	Q-C
					B-C	-2307 / 0	-91.8	-91.8	0.37 (1)	4.19	C-P
					C-D	-2188 / 0	-91.8	-91.8	0.35 (1)	4.28	P-D
					D-E	-2302 / 0	-91.8	-91.8	0.85 (1)	3.36	D-N
					E-F	-2302 / 0	-91.8	-91.8	0.85 (1)	3.36	N-E
					F-G	-2188 / 0	-91.8	-91.8	0.35 (1)	4.29	N-F
					G-H	-2307 / 0	-91.8	-91.8	0.35 (1)	4.19	F-G
					H-I	0 / 35	-91.8	-91.8	0.12 (1)	10.00	L-G
					R-B	-2017 / 0	0.0	0.0	0.21 (1)	5.94	K-G
					J-H	-2017 / 0	0.0	0.0	0.21 (1)	5.94	B-Q
					R-Q	0 / 0	-18.5	-18.5	0.10 (4)	10.00	K-H
					C-P	0 / 1944	-18.5	-18.5	0.40 (1)	10.00	
					P-O	0 / 1797	-18.5	-18.5	0.41 (1)	10.00	
					O-N	0 / 1797	-18.5	-18.5	0.41 (1)	10.00	
					N-M	0 / 1797	-18.5	-18.5	0.41 (1)	10.00	
					M-L	0 / 1797	-18.5	-18.5	0.41 (1)	10.00	
					L-K	0 / 1944	-18.5	-18.5	0.40 (1)	10.00	
					K-J	0 / 0	-18.5	-18.5	0.10 (4)	10.00	

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	6.0	1.75 2.75
C	TMVW-t	MT20	4.0	4.0	2.00 1.50
D	TTVW-m	MT20	5.0	6.0	2.25 1.75
E	TMVW-w	MT20	2.0	4.0	
F	TTVW-m	MT20	5.0	6.0	2.25 1.75
G	TMVW-t	MT20	4.0	4.0	2.00 1.50
H	TMVW-p	MT20	5.0	6.0	1.75 2.75
I	BMV1-p	MT20	3.0	4.0	
J	BMVW-t	MT20	5.0	6.0	2.50 2.75
K	BMVW-t	MT20	4.0	4.0	
L	BS-t	MT20	3.0	6.0	
M	BMVW-w	MT20	4.0	9.0	
N	BS-t	MT20	3.0	6.0	
O	BMVW-t	MT20	4.0	4.0	
P	BMVW-t	MT20	5.0	6.0	2.50 2.75
Q	BMV1-p	MT20	3.0	4.0	

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.17")
 CALCULATED VERT. DEFL.(LL) = $L/999$ (0.11")
 ALLOWABLE DEFL.(TL) = $L/360$ (1.17")
 CALCULATED VERT. DEFL.(TL) = $L/999$ (0.22")

CSI: TC=0.85/1.00 (E-F:1), BC=0.41/1.00 (N-P:1),
 WB=0.45/1.00 (B-Q:1), SS=0.34/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.87 (B) (INPUT = 0.90)
 JSI METAL = 0.59 (C) (INPUT = 1.00)



Tamarack Roof Truss, Burlington

 Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 11:19:20 2020 Page 1
 ID:DMCubINVR6tstFoe31v6l_zns1-7CJlqYXU4Uo78rDz6IQJ_MvRGVVCOpnCyTLAXzLZ45
 23-2.8 3-10-11 27-1.3 28-11.8 30-11-13 33-0.4 35-1.0 36-4.9
 1-3.8 0-0 6-1.8 11-10.8 17-5.8 5-8.0 5-8.0 5-8.0 2-0.7 2-0.12 1-3.8
 Scale = 1/8"=1'-0"



ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.


FASTEN 1 AND BRACES TO NARROW EDGE OF WEB WITH ONE ROW PERFPLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 9" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

H-I	-9190 / 0	-91.8	-91.8	0.17 (1)	4.71	N-I	-10507 / 0	0.84 (1)	NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION
I-J	-8 / 0	-91.8	-91.8	0.10 (1)	10.00	T-C	-6246 / 0	0.87 (1)	

FACTORED CONCENTRATED LOADS (LBS)

Structural component only

Continued on page 2



JOB NAME 408315	TRUSS NAME T4	QUANTITY 1	PLY 3	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.					

Tamareck Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 11:19:20 2020 Page 2
ID:DMCubINVR8TstFoe31v6I zns1I-7CJldYXU4Up78Dz6IQJ MvRGYVC9phCvTLIAxZLZ45

STAGGER NAILS BY HALF THE SURFACE SPACING IN ADJACENT PLIES.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	6.0		
C	TMWW-1	MT20	10.0	20.0	4.75	6.75
D	TS-1	MT20	5.0	6.0		
E	TTWW+m	MT20	5.0	6.0	4.00	1.50
F	TMW+w	MT20	3.0	6.0		
G	TTWW+m	MT20	5.0	6.0	4.00	1.50
H	TS-1	MT20	5.0	6.0		
I	TMWW-1	MT20	10.0	20.0	4.75	6.75
J	TMV+p	MT20	3.0	6.0		
L	BMWW-1	MT20	6.0	12.0	2.50	5.50
M	BMW+w	MT20	10.0	12.0	Edge	
N	BMWW-1	MT20	5.0	6.0	4.00	2.00
O	BS-1	MT20	5.0	6.0		
P	BMWW-1	MT20	5.0	6.0		
Q	BS-1	MT20	5.0	6.0		
R	BMWW-1	MT20	5.0	6.0	4.00	2.00
S	BMW+w	MT20	10.0	12.0	Edge	
T	BMWW-1	MT20	6.0	12.0	2.50	5.50

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.




Structural component only
DWG# T-2008008 2/2

Structural component only
DWG# T-2008009

JOB NAME 408315	TRUSS NAME T6	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Pool Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 09:31:39 2020 Page 1

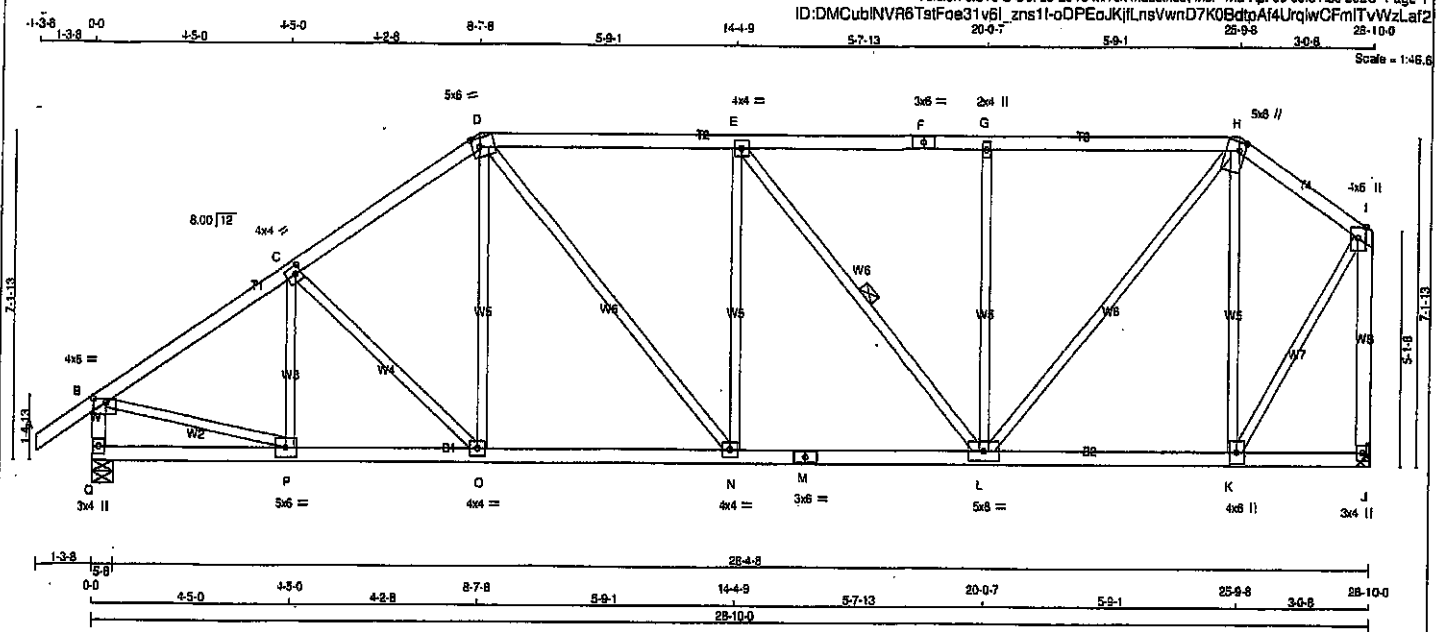

TOTAL WEIGHT = 135 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
I - B	2x4	DRY	No.2
O - B	2x4	DRY	No.2
J - I	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN Y	X
B TMVW-p	MT20	4.0	6.0	1.00 3.25
C TMVW-l	MT20	4.0	4.0	2.00 1.50
D TTWW-m	MT20	5.0	6.0	2.25 2.00
E TMVW-l	MT20	4.0	4.0	
F TS-l	MT20	3.0	6.0	
G TMVW-w	MT20	2.0	4.0	
H TTWW-m	MT20	5.0	6.0	2.25 1.50
I TMVW-p	MT20	4.0	6.0	Edge
J BMV1-p	MT20	3.0	4.0	
K BMVW-l	MT20	4.0	6.0	
L BMVW-w	MT20	5.0	6.0	
M BS-l	MT20	3.0	6.0	
N BMVW-l	MT20	4.0	4.0	
O BMVW-l	MT20	4.0	4.0	
P BMVW-l	MT20	5.0	6.0	
Q BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT REQRD BRG
Q	1715 0	1715 0	5-8
J	1589 0	1589 0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
Q	1211	808 / 0	0 / 0	0 / 0	0 / 0	0 / 0	403 - 0	0 / 0
J	1124	738 / 0	0 / 0	0 / 0	0 / 0	0 / 0	388 - 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.50 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC1)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC1)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8 -91.8	0.12 (1)	10.00	P-C	-295 / 0	0.08 (1)
B-C	-1814 / 0	-91.8 -91.8	0.35 (1)	4.61	C-O	-168 / 0	0.10 (1)
C-D	-1720 / 0	-91.8 -91.8	0.33 (1)	4.72	O-D	0 / 211	0.05 (1)
D-E	-1720 / 0	-91.8 -91.8	0.50 (1)	4.50	D-N	0 / 481	0.11 (1)
E-F	-1484 / 0	-91.8 -91.8	0.47 (1)	4.82	N-E	-261 / 2	0.23 (1)
F-G	-1484 / 0	-91.8 -91.8	0.47 (1)	4.82	E-L	-402 / 0	0.22 (1)
G-H	-1484 / 0	-91.8 -91.8	0.47 (1)	4.89	L-G	-559 / 0	0.51 (1)
H-I	-786 / 0	-91.8 -91.8	0.15 (1)	6.25	L-H	0 / 1282	0.29 (1)
Q-B	-1678 / 0	0.0 0.0	0.17 (1)	6.41	K-H	-900 / 0	0.80 (1)
J-I	-1574 / 0	0.0 0.0	0.75 (1)	6.58	B-P	0 / 1575	0.35 (1)
					K-I	0 / 1191	0.27 (1)
Q-P	0 / 0	-18.5 -18.5	0.07 (4)	10.00			
P-O	0 / 1530	-18.5 -18.5	0.30 (1)	10.00			
O-N	0 / 1410	-18.5 -18.5	0.29 (1)	10.00			
N-M	0 / 1720	-18.5 -18.5	0.34 (1)	10.00			
M-L	0 / 1720	-18.5 -18.5	0.34 (1)	10.00			
L-K	0 / 639	-18.5 -18.5	0.17 (4)	10.00			
K-J	0 / 0	-18.5 -18.5	0.09 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 089-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.96")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (0.96")
CALCULATED VERT. DEFL.(TL) = L/999 (0.13")

CSI: TC=0.75/1.00 (I-J-1), BC=0.34/1.00 (L-N-1),
WB=0.80/1.00 (H-K-1), SSI=0.25/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618 354 1867 788 1987 1856	


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP=0.89 (H) (INPUT = 0.90)
JSI METAL=0.53 (M) (INPUT = 1.00)



Structural component only
DWG# T-2008010

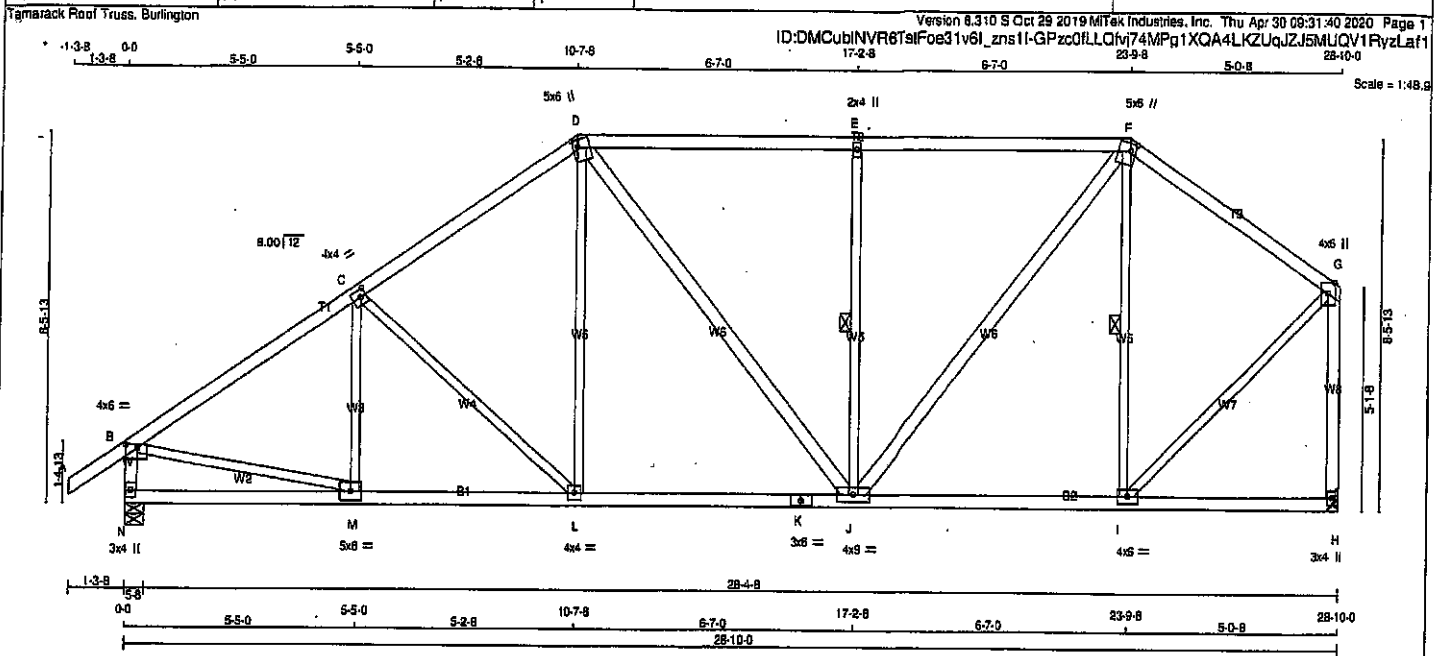

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	NO.2	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - G	2x4	DRY	No.2	SPF
N - B	2x4	DRY	No.2	SPF
H - G	2x4	DRY	No.2	SPF
N - K	2x4	DRY	No.2	SPF
K - H	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
D - J	2x4	DRY	No.2	SPF
J - F	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	8.0	1.00	3.25
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TTVW+m	MT20	5.0	8.0	2.00	1.50
E	TMVW-w	MT20	2.0	4.0		
F	TTVW+m	MT20	5.0	6.0	2.00	1.50
G	TMVW+p	MT20	4.0	6.0	Edge	
H	BMV1+p	MT20	3.0	4.0		
I	BMVW-t	MT20	4.0	6.0		
J	BMVWVW-t	MT20	4.0	9.0		
K	BS-t	MT20	3.0	6.0		
L	BMVWV-t	MT20	4.0	4.0		
M	BMVWV-t	MT20	5.0	6.0		
N	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED		MAXIMUM FACTORED		INPUT	REQD	
	GROSS REACTION		GROSS REACTION		BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
N	1715	0	1715	0	0	5-8	5-8
H	1589	0	1589	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3'-8".

UNFACTORED REACTIONS

1ST CASE		MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
N	1211	808 / 0	0 / 0	0 / 0	0 / 0	403 / 0	0 / 0
H	1124	738 / 0	0 / 0	0 / 0	0 / 0	386 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.54 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-J, F-I.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. MAX. CSI (LC)	
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	M-C	-209 / 15	0.08 (1)
B-C	-1848 / 0	-91.8	-91.8 0.39 (1)	4.54	C-L	-343 / 0	0.33 (1)
C-D	-1806 / 0	-91.8	-91.8 0.37 (1)	4.83	L-D	0 / 338	0.08 (1)
D-E	-1412 / 0	-91.8	-91.8 0.56 (1)	4.77	D-J	0 / 182	0.03 (1)
E-F	-1412 / 0	-91.8	-91.8 0.55 (1)	4.77	J-E	-745 / 0	0.34 (1)
F-G	-993 / 0	-91.8	-91.8 0.31 (1)	5.87	J-F	0 / 950	0.15 (1)
N-B	-1672 / 0	0.0	0.0 0.17 (1)	8.42	I-F	-650 / 0	0.30 (1)
H-G	-1554 / 0	0.0	0.0 0.74 (1)	6.61	B-M	0 / 1595	0.38 (1)
					I-G	0 / 1123	0.25 (1)
N-M	0 / 0	-18.5	-18.5 0.11 (4)	10.00			
M-L	0 / 1564	-18.5	-18.5 0.32 (1)	10.00			
L-K	0 / 1311	-18.5	-18.5 0.29 (1)	10.00			
K-J	0 / 1311	-18.5	-18.5 0.29 (1)	10.00			
J-I	0 / 817	-18.5	-18.5 0.23 (4)	10.00			
I-H	0 / 0	-18.5	-18.5 0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.96")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.96")
CALCULATED VERT. DEFL.(TL) = L/999 (0.13")

CSI: TC=0.74/1.00 (G-H:1), BC=0.32/1.00 (L-M:1), WB=0.38/1.00 (B-M:1), SS=0.29/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

MAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION (PS)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	518	354	1867	788

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (S) (INPUT = 0.90)
JSI METAL= 0.52 (G) (INPUT = 1.00)



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	T8	1	1	GREEN PARK HOMES	
Tomerack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Thu Apr 30 09:31:42 2020 Page 1
ID:DMCubINVR6tstFoe31v6f_zns1H-C65MRKncxG9RMOWooSZuFVRidHVS18sexk_8WzrLat?

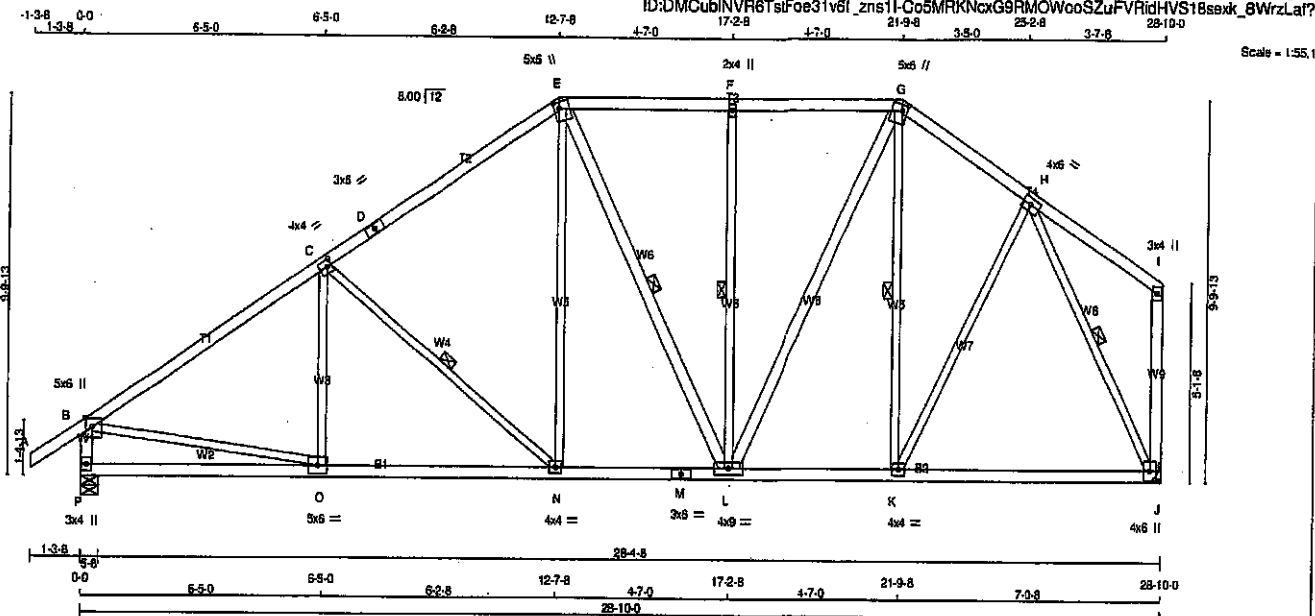

TOTAL WEIGHT = 153 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
E - G	2x4	DRY	No.2	SPF	
G - I	2x4	DRY	No.2	SPF	
I - J	2x4	DRY	No.2	SPF	
J - K	2x4	DRY	No.2	SPF	
K - L	2x4	DRY	No.2	SPF	
L - M	2x4	DRY	No.2	SPF	
M - J	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
E - L	2x4	DRY	No.2	SPF	
L - G	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	8.0	2.75	2.00
C	TMVW-i	MT20	4.0	4.0	2.00	1.50
D	TS-i	MT20	3.0	6.0		
E	TTWW+m	MT20	5.0	6.0	2.00	1.50
F	TMVW-w	MT20	2.0	4.0		
G	TTWW+m	MT20	5.0	6.0	2.00	1.50
H	TMVW-i	MT20	4.0	4.0		
I	TMV+p	MT20	3.0	4.0		
J	BMVW1+p	MT20	4.0	4.0		
K	BMVW-i	MT20	4.0	4.0		
L	BS-i	MT20	4.0	9.0		
M	BS-i	MT20	3.0	6.0		
N	BMVW-i	MT20	4.0	4.0		
O	BMVW-i	MT20	5.0	6.0		
P	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
P	1715	0	1715	0
J	1589	0	1589	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3'-8".

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS
	COMBINED	SNOW	LIVE
P	1211	808 / 0	0 / 0
J	1124	738 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.29 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-N, E-L, F-L, G-K, H-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8 -91.8 0.12 (1)	10.00	C-C	-134 / 61	0.07 (1)	
B-C	-1855 / 0	-91.8 -91.8 0.58 (1)	4.28	C-N	-510 / 0	0.24 (1)	
C-D	-1487 / 0	-91.8 -91.8 0.52 (1)	4.77	N-E	0 / 435	0.10 (1)	
D-E	-1487 / 0	-91.8 -91.8 0.52 (1)	4.77	E-L	-23 / 0	0.01 (4)	
E-F	-1182 / 0	-91.8 -91.8 0.28 (1)	5.58	L-F	-512 / 0	0.33 (1)	
F-G	-1182 / 0	-91.8 -91.8 0.28 (1)	5.58	G-K	0 / 653	0.10 (1)	
G-H	-1107 / 0	-91.8 -91.8 0.15 (1)	5.85	K-G	-289 / 0	0.17 (1)	
H-I	0 / 21	-91.8 -91.8 0.18 (1)	10.00	K-H	0 / 454	0.10 (1)	
I-J	-1866 / 0	0.0 0.0 0.17 (1)	6.42	B-O	0 / 1598	0.35 (1)	
J-P	-125 / 0	0.0 0.0 0.08 (1)	7.81	H-J	-1573 / 0	0.66 (1)	
P-O	0 / 0	-18.5 -18.5 0.18 (4)	10.00				
O-N	0 / 1576	-18.5 -18.5 0.34 (1)	10.00				
N-M	0 / 1191	-18.5 -18.5 0.25 (1)	10.00				
M-L	0 / 1191	-18.5 -18.5 0.25 (1)	10.00				
L-K	0 / 899	-18.5 -18.5 0.28 (4)	10.00				
K-J	0 / 699	-18.5 -18.5 0.28 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.5 PSF
DL	= 8.0 PSF
BOT CH.	LL = 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPC 2011, TPC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.5 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.96")
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
ALLOWABLE DEFL.(TL) = L/360 (0.96")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.58/1.00 (B-C:1), BC=0.34/1.00 (N-O:1), WB=0.68/1.00 (H-J:1), SS=0.24/1.00 (B-C:1)

COL LUMBER=1.00 NAIL=1.00 LS SEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MT20	618	354
	1667	788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (B) (INPUT = 0.90)
JSI METAL= 0.77 (B) (INPUT = 1.00)

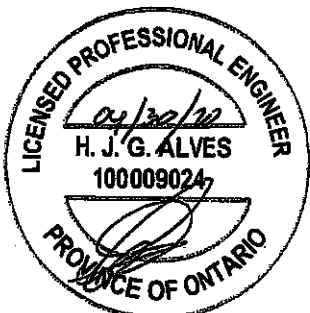


Structural component only
DWG# T-2008012

JOB NAME 408315	TRUSS NAME T9	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	-------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:43 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-g_flegNEiaHl_Y5_Ma47nizqmhm?mYHoAOjH2HzLaf

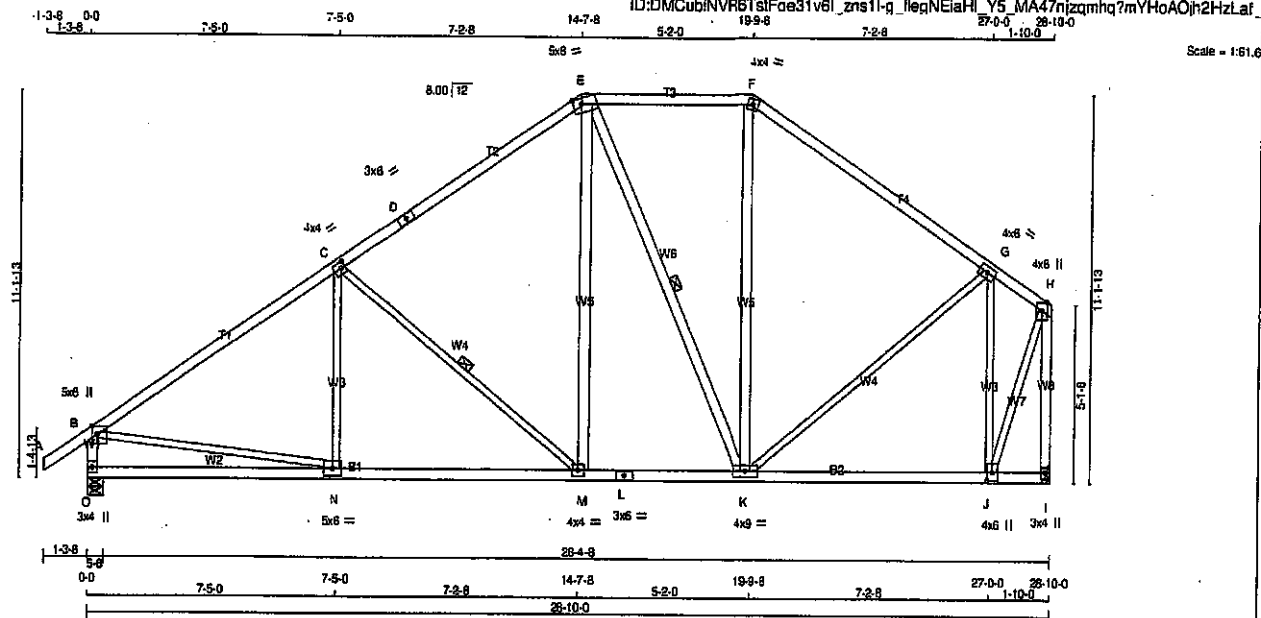

TOTAL WEIGHT = 4 X 151 = 605 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
O - B	2x4	DRY	No.2
I - H	2x4	DRY	No.2
O - L	2x4	DRY	No.2
L - I	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
M - E	2x4	DRY	No.2
E - K	2x4	DRY	No.2
K - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table/s in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	5.0	2.75 2.00
C	TMWW-t	MT20	4.0	4.0	2.00 1.50
D	TS-t	MT20	3.0	6.0	
E	TTWW-m	MT20	5.0	8.0	2.00 3.00
F	TTW-m	MT20	4.0	4.0	
G	TMWW-t	MT20	4.0	6.0	
H	TMVW+p	MT20	4.0	6.0	Edge
I	BMV1+p	MT20	3.0	4.0	
J	BMVW-t	MT20	4.0	6.0	2.75 2.00
K	BMWW-t	MT20	4.0	9.0	
L	BS-t	MT20	3.0	5.0	
M	BMWW-t	MT20	4.0	4.0	
N	BMWW-t	MT20	5.0	5.0	
O	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG
O	1715	0	0	1715	0	0	5-8	5-8	5-8
I	1589	0	0	1589	0	0	MECHANICAL		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN.	COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
O	1211	808 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	403 / 0	0 / 0
I	1124	738 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	386 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.91 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-M, E-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED CSI (LC)
FR-TO		FROM TO	LENGTH	FR-TO		FROM TO	LENGTH
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	N-C	-72 / 101	0.05 (1)
B-C	-1842 / 0	-91.8	-91.8 0.81 (1)	3.91	C-M	-667 / 0	0.42 (1)
C-D	-1314 / 0	-91.8	-91.8 0.72 (1)	4.58	M-E	0 / 525	0.08 (1)
D-E	-1314 / 0	-91.8	-91.8 0.72 (1)	4.58	E-K	-335 / 0	0.27 (1)
E-F	-921 / 0	-91.8	-91.8 0.32 (1)	8.02	K-F	0 / 119	0.03 (4)
F-G	-1141 / 0	-91.8	-91.8 0.82 (1)	5.07	K-G	0 / 490	0.11 (1)
G-H	-509 / 0	-91.8	-91.8 0.49 (1)	8.25	J-G	-1297 / 0	0.84 (1)
H-I	-1650 / 0	0.0	0.0 0.17 (1)	8.44	B-N	0 / 1587	0.38 (1)
I-H	-1608 / 0	0.0	0.0 0.77 (1)	8.52	J-H	0 / 1514	0.34 (1)
O-N	0 / 0	-18.5	-18.5 0.28 (4)	10.00			
N-M	0 / 1570	-18.5	-18.5 0.38 (1)	10.00			
M-L	0 / 1061	-18.5	-18.5 0.28 (1)	10.00			
L-K	0 / 1061	-18.5	-18.5 0.28 (1)	10.00			
K-J	0 / 540	-18.5	-18.5 0.21 (4)	10.00			
J-I	0 / 0	-18.5	-18.5 0.17 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OSC 2012, ABC 2019
- PART 9 OF OSC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TRC 2011, TRC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.96")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.06")
ALLOWABLE DEFL. (TL) = $L/360$ (0.96")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.14")

CSI: TC=0.81/1.00 (B-C:1), BC=0.39/1.00 (M-N:1), WB=0.84/1.00 (G-J:1), SS=0.27/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR SECTION (PSI)	PLI	PLI
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1867 788	1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (B) (INPUT = 0.90)
JSI METAL = 0.77 (B) (INPUT = 1.00)

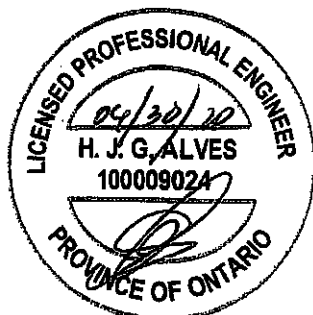

Structural component only
DWG# T-2008013

JOB NAME 408315	TRUSS NAME T10	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington


Version 8.310 S Oct 25 2019 Mittek Industries, Inc. Thu Apr 30 09:31:45 2020 Page 2

ID:DMCubINVH6TslFos31v6l zns1-dMmV3MPUEBX0DREMTa7bt83EvVR3EVWp5eCo6AzLggy

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-p	MT20	5.0	8.0	Edge	
C	TTWW+m	MT20	5.0	8.0	Edge	
D	TMWW-t	MT20	5.0	8.0		
E, F, H						
E	TMWW-t	MT20	5.0	8.0		
G	TS-t	MT20	5.0	8.0		
I	TMWW-t	MT20	5.0	8.0		
J	TTWW+m	MT20	5.0	8.0	Edge	
K	TMWW-p	MT20	5.0	8.0	Edge	
M	BMV1-p	MT20	3.0	8.0		
N	BMWW-t	MT20	5.0	6.0	2.50	2.50
O	BMWW-t	MT20	5.0	6.0	3.00	2.00
P	BS-t	MT20	5.0	8.0		
Q	BMWW-t	MT20	5.0	8.0		
R	BMWW-t	MT20	5.0	8.0		
S	BMWW-t	MT20	5.0	8.0		
T	BMWW-t	MT20	5.0	8.0		
U	BS-t	MT20	5.0	8.0		
V	BMWW-t	MT20	5.0	6.0	3.00	2.00
W	BMWW-t	MT20	5.0	6.0	2.50	2.50
X	BMV1-p	MT20	3.0	6.0		


Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

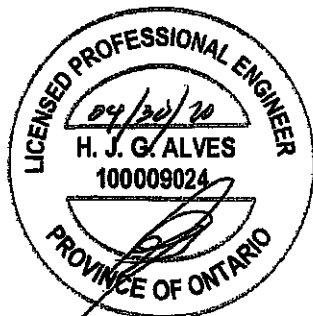

Structural component only
DWG# T-2008014

42

JOB NAME 408315	TRUSS NAME T11	QUANTITY 1	PLY 3	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 09:31:46 2020 Page 1	
ID:DMCubINVR6tstF0e31v6l_zns11-5ZKIGIG8?Vtr?pZ1leqLbSCvnXzvWEsMyLacZLaex					
Scale = 1:57.0					

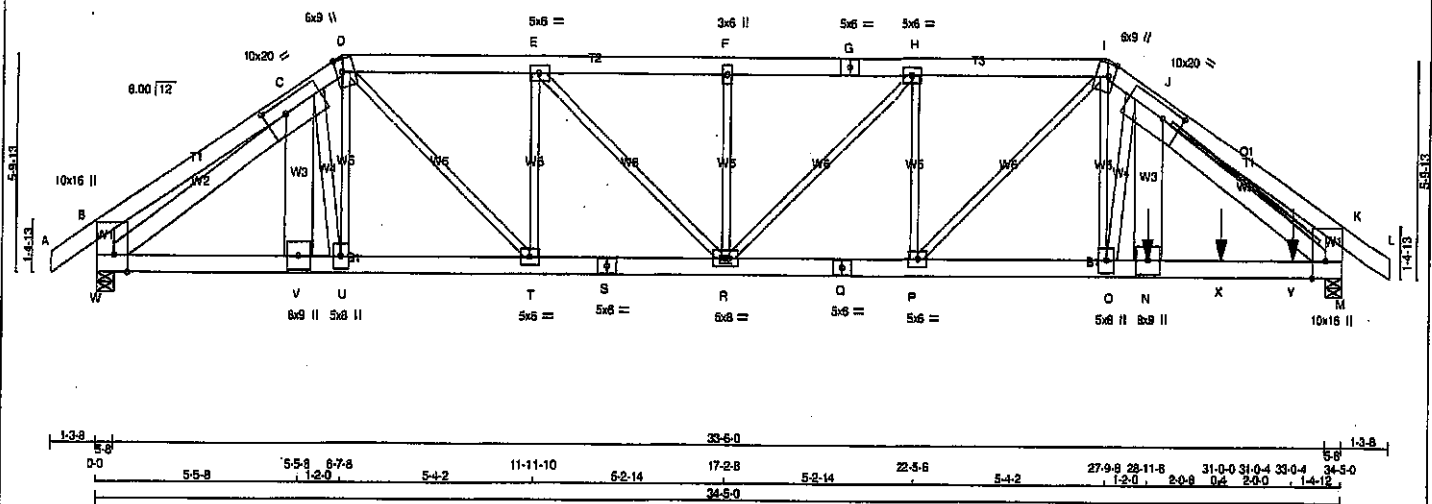

LUMBER N.L.G.A. RULES CHORDS SIZE LUMBER DESCR. A - D 2x6 DRY No.2 SPF D - G 2x6 DRY No.2 SPF G - I 2x6 DRY No.2 SPF I - L 2x6 DRY No.2 SPF W - B 2x6 DRY No.2 SPF M - K 2x6 DRY No.2 SPF S - S 2x6 DRY 1850F 1.5E SPF S - Q 2x6 DRY 1850F 1.5E SPF Q - M 2x6 DRY 1850F 1.5E SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT V - C 2x10 DRY No.2 SPF C - U 2x4 DRY No.2 SPF U - C 2x6 DRY No.2 SPF N - J 2x10 DRY No.2 SPF O - J 2x4 DRY No.2 SPF J - M 2x6 DRY No.2 SPF DRY, SEASONED LUMBER. DESIGN CONSISTS OF 3 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS: CHORDS #ROWS SURFACE SPACING (IN) LOAD(PLF) TOP CHORDS : (0.122"x3") SPIRAL NAILS A-D 2 12 TOP D-G 2 12 TOP G-I 2 12 TOP I-L 2 12 TOP W-B 2 12 TOP M-K 2 12 TOP BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS W-S 2 5 TOP S-Q 2 12 TOP Q-M 2 5 TOP WEBS : (0.122"x3") SPIRAL NAILS 2x3 1 6 SIDE(2940.4) 2x4 1 6 2x6 2 6 J-N 5 4 2x10 5 4 STAGGER NAILS BY HALF THE SURFACE SPACING IN ADJACENT PLIES.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED MAXIMUM FACTORED INPUT REQ'D GROSS REACTION GROSS REACTION BRG BRG JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX W 4072 0 4072 0 0 5-8 5-8 M 14508 0 14508 0 0 5-8 5-8 UNFACTORED REACTIONS 1ST CASE MAX/MIN COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL W 2875 1913/0 0/0 0/0 0/0 962-0 0/0 M 10243 6815/0 0/0 0/0 0/0 3428-0 0/0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) W, M BEARING SIZE FACTOR = 1.15 AT JNT(S) M (BASED ON SUPPORT DEPTH = 1-8) BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.59 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED. 2x6 DRY SPF No.2 T-BRACE AT J-M FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 8" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 80% OF WEB LENGTH. END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW LOADING TOTAL LOAD CASES: (4) CHORDS FACTORED FACTORED WEBS MEMB. MAX. FORCE VERT. LOAD LC1 MAX. MAX. MEMB. MAX. FORCE MAX. (LBS) (PLF) CSI (LC) UNBRAC (LBS) CSI (LC) FR-TO FROM TO LENGTH FR-TO A-B 0/36 -91.8 -91.8 0.02 (1) 10.00 V-C -150/21 0.00 (1) B-C 0/15 -91.8 -91.8 0.08 (1) 10.00 C-U 0/321 0.02 (1) C-D -5481/0 -91.8 -91.8 0.04 (1) 5.87 U-D -14/14 0.00 (1) D-E -7359/0 -91.8 -91.8 0.09 (1) 5.22 D-T 0/4079 0.31 (1) E-F -9618/0 -91.8 -91.8 0.10 (1) 4.69 T-E -2816/0 0.42 (1) F-G -9618/0 -91.8 -91.8 0.10 (1) 4.69 E-R 0/3233 0.24 (1) G-H -9618/0 -91.8 -91.8 0.10 (1) 4.69 R-F -447/0 0.07 (1) H-I -11353/0 -91.8 -91.8 0.14 (1) 4.35 R-H -2481/0 0.87 (1) I-J -15043/0 -91.8 -91.8 0.35 (1) 3.59 P-H 0/1284 0.10 (1) J-K -114/0 -91.8 -91.8 0.25 (1) 6.25 O-I -1775/0 0.83 (1) K-L 0/36 -91.8 -91.8 0.02 (1) 10.00 O-I 0/8939 0.66 (1) W-B -349/0 0.0 0.0 0.01 (1) 7.81 W-C -5708/0 0.80 (1) M-K -580/0 0.0 0.0 0.01 (1) 7.81 N-J 0/13391 0.37 (1) W-V 0/4361 -18.5 -18.5 0.13 (1) 10.00 C-J -3236/0 0.85 (1) V-U 0/4377 -18.5 -18.5 0.13 (1) 10.00 J-M -19292/0 0.79 (1) U-T 0/4472 -18.5 -18.5 0.14 (1) 10.00 T-S 0/7359 -18.5 -18.5 0.20 (1) 10.00 S-R 0/7359 -18.5 -18.5 0.20 (1) 10.00 R-Q 0/11353 -18.5 -18.5 0.30 (1) 10.00 Q-P 0/11353 -18.5 -18.5 0.30 (1) 10.00 P-O 0/12609 -18.5 -18.5 0.36 (1) 10.00 O-N 0/15181 -18.5 -18.5 0.48 (1) 10.00 N-X 0/14810 -18.5 -18.5 0.72 (1) 10.00 X-Y 0/14810 -18.5 -18.5 0.72 (1) 10.00 Y-M 0/14810 -18.5 -18.5 0.72 (1) 10.00 FACTORED CONCENTRATED LOADS (LBS) JT LOC. LC1 MAX- MAX+ FACE DIR. TYPE HEEL CONN. N 28-11-8 -11612 -11612 --- FRONT VERT TOTAL --- C1 X 31-0-4 -1466 -1466 --- FRONT VERT TOTAL --- C1 Y 33-0-4 -1466 -1466 --- FRONT VERT TOTAL --- C1				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 25.6 PSF DL = 8.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF CBC 2018, CBC 2012, ABC 2019 - PART 9 OF CBC 2012 (2019 AMENDMENT) - CSA 086-09, CSA 086-14 - TPIC 2011, TPIC 2014 (55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL) = L/360 (1.15") CALCULATED VERT. DEFL.(LL) = U/999 (0.13") ALLOWABLE DEFL.(TL) = L/360 (1.15") CALCULATED VERT. DEFL.(TL) = U/999 (0.24") CSI: TC=0.35/1.00 (H-T:1), BC=0.72/1.00 (M-N:1), WB=0.87/1.00 (H-R:1), SSI=0.31/1.00 (M-N:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=t.10 SHEAR=1.10 TENS=1.10 COMPANION LIVE LOAD FACTOR = 1.00 AUTOSOLVE HEELS OFF TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(OR) SHEAR SECTION (PSU) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 788 1987 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.88 (I) (INPUT = 0.80) JSI METAL= 0.92 (N) (INPUT = 1.00)			
--	--	--	--	--	--	--	--	---	--	--	--



Structural component only
DWG# T-2008015

JOB NAME 408315	TRUSS NAME T11	QUANTITY 1	PLY 3	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:46 2020 Page 2
ID:DMCubINVR6TstFoe31v6l_zns1l-5ZKIGQ67Vtr7pZ1legPLbSCvnXzvWEsMyl.eczLaex

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B, K, M, W						
B						
B	TMSMW1*	pMT20	10.0	16.0	Edge	4.50
C	TMWWW-1	MT20	10.0	20.0	4.00	6.75
D	TTWW+m	MT20	6.0	9.0	4.00	2.00
E	TMWW-1	MT20	5.0	6.0		
F	TMW+w	MT20	3.0	6.0		
G	TS-1	MT20	5.0	6.0		
H	TMWW-1	MT20	5.0	6.0		
I	TTWW+m	MT20	6.0	9.0	4.00	2.00
J	TMWWW-1	MT20	10.0	20.0	4.00	6.75
M	TMSMW1*	pMT20	10.0	16.0	Edge	4.50
N	BMW+w	MT20	8.0	9.0		
O	BMWW-1	MT20	5.0	8.0		
P	BMWW-1	MT20	5.0	8.0		
Q	BS-1	MT20	5.0	6.0		
R	BMWWW-1	MT20	5.0	8.0		
S	BS-1	MT20	5.0	6.0		
T	BMWW-1	MT20	5.0	6.0		
U	BMWW-1	MT20	5.0	8.0		
V	BMW+w	MT20	8.0	9.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

II C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2008016

JOB NAME 408315	TRUSS NAME T12	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 09:31:48 2020 Page 1
ID:DMCubINVR6TsFoe31v6l_zns1l-1xSehORNX6v64Jzx8jilUmhltiRpxXKqRSiVzLaev

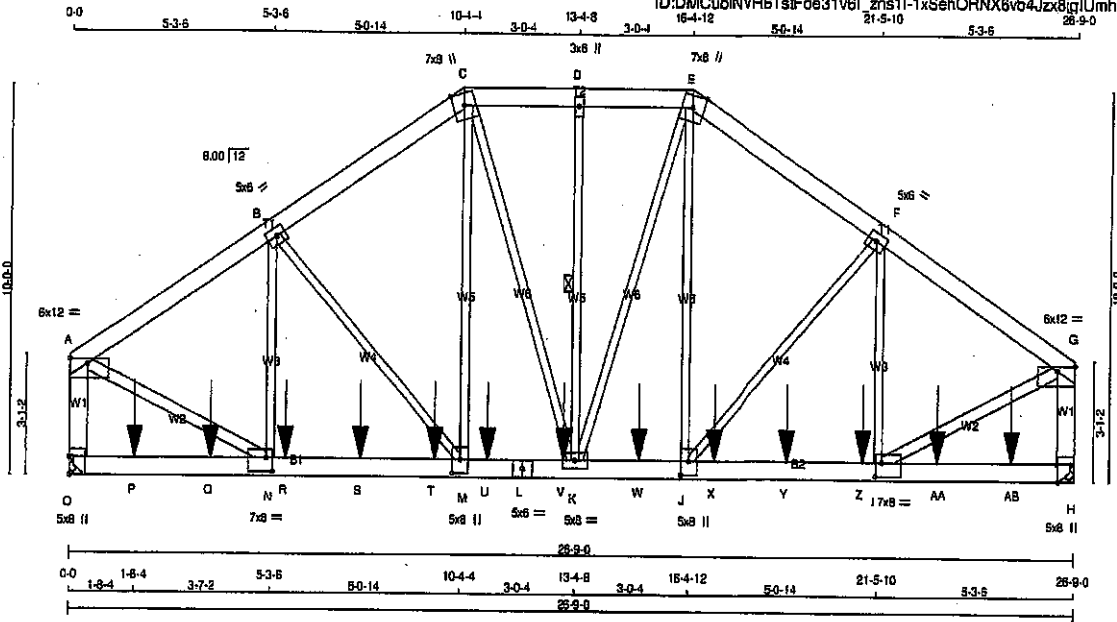

Scale = 1:54.9

CHORDS	SIZE	DRY	LUMBER	DESCR
A - C	2x6	DRY	No.2	SPF
C - E	2x6	DRY	No.2	SPF
E - G	2x6	DRY	No.2	SPF
O - A	2x6	DRY	No.2	SPF
H - G	2x6	DRY	No.2	SPF
O - L	2x6	DRY	2100F 1.8E	SPF
L - H	2x6	DRY	2100F 1.8E	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
A - N	2x4	DRY	No.2	SPF
I - G	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C 2	12	TOP
C-E 2	12	TOP
E-G 2	12	TOP
O-A 2	12	TOP
H-G 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
O-L 2	12	SIDE(0.0)
L-H 2	12	SIDE(197.8)
WEBS : (0.122"x3") SPIRAL NAILS		
D-K 1	6	SIDE(212.1)
2x3 1	6	
2x4 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	DOWN	UPLIFT	IN-SX
O 11741	0	0	MECHANICAL
H 11631	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT O, H. MINIMUM BEARING LENGTH AT JOINT O = 5'-0, JOINT H = 5'-0.

UNFACTORED REACTIONS

1ST CASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW
O	8292	5505 / 0
H	8214	5453 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.55 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF D-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD LC1	MAX	MAX.	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD	PLF	CSI (LC)	UNBRAC	MEMB.	FORCE
FR-TO					LENGTH	FR-TO	
A-B	-10728 / 0	-91.8	-91.8	0.30 (1)	3.58	N-B	0 / 483
B-C	-10099 / 0	-91.8	-91.8	0.28 (1)	3.89	B-M	-858 / 0
C-D	-8728 / 0	-91.8	-91.8	0.16 (1)	4.02	M-C	0 / 4208
D-E	-8728 / 0	-91.8	-91.8	0.16 (1)	4.02	C-K	0 / 1003
E-F	-9962 / 0	-91.8	-91.8	0.26 (1)	3.72	K-D	-70 / 24
F-G	-10612 / 0	-91.8	-91.8	0.29 (1)	3.59	K-E	0 / 1389
D-A	-10565 / 0	0.0	0.0	0.54 (1)	4.64	J-E	0 / 3755
H-G	-10453 / 0	0.0	0.0	0.53 (1)	4.66	J-F	-867 / 0
						I-F	0 / 515
						A-N	0 / 9949
						I-G	0 / 9843
O-P	0 / 0	-18.5	-18.5	0.44 (1)	10.00		
P-Q	0 / 0	-18.5	-18.5	0.44 (1)	10.00		
Q-N	0 / 0	-18.5	-18.5	0.44 (1)	10.00		
N-R	0 / 8933	-18.5	-18.5	0.67 (1)	10.00		
R-S	0 / 8933	-18.5	-18.5	0.67 (1)	10.00		
S-T	0 / 8933	-18.5	-18.5	0.67 (1)	10.00		
T-M	0 / 8933	-18.5	-18.5	0.67 (1)	10.00		
M-U	0 / 8425	-18.5	-18.5	0.42 (1)	10.00		
U-L	0 / 8425	-18.5	-18.5	0.42 (1)	10.00		
L-V	0 / 8425	-18.5	-18.5	0.42 (1)	10.00		
V-K	0 / 8425	-18.5	-18.5	0.42 (1)	10.00		
K-W	0 / 8305	-18.5	-18.5	0.43 (1)	10.00		
W-J	0 / 8305	-18.5	-18.5	0.43 (1)	10.00		
J-X	0 / 8937	-18.5	-18.5	0.87 (1)	10.00		
X-Y	0 / 8937	-18.5	-18.5	0.87 (1)	10.00		
Y-Z	0 / 8937	-18.5	-18.5	0.87 (1)	10.00		
Z-I	0 / 8937	-18.5	-18.5	0.87 (1)	10.00		
I-AA	0 / 0	-18.5	-18.5	0.44 (1)	10.00		
AA-AB	0 / 0	-18.5	-18.5	0.44 (1)	10.00		
AB-H	0 / 0	-18.5	-18.5	0.44 (1)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
P	1'-8.4	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
O	3'-8.4	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
R	5'-8.4	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
S	7'-8.4	-1571	-1571	---	BACK	VERT	TOTAL	---	C1

TOTAL WEIGHT = 2 X 184 = 368 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.89")
CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
ALLOWABLE DEFL.(TL) = L/360 (0.89")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CSI: TC=0.54/1.00 (A-O-1), SC=0.67/1.00 (M-N-1), WB=0.88/1.00 (A-N-1), SSI=0.93/1.00 (M-N-1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1567 788 1937 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (I) (INPUT = 0.90)
JSI METAL = 0.84 (N) (INPUT = 1.00)



Structural component only
DWG# T-2008017 1/2

CONTINUED ON PAGE 2

JOB NAME 408315	TRUSS NAME T12	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:48 2020 Page 2
ID:DMCubiNVVR6TsiFoe31v6I zns1l-1xSehOPINX6vb4Jzx8qIUmhlITiRpxXKgRSivzLaev

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWV-p	MT20	6.0	12.0	1.50	Edge
B	TMWV-t	MT20	5.0	6.0		
C	TTWW+m	MT20	7.0	8.0		Edge
D	TMWV-w	MT20	3.0	6.0		
E	TTWW+m	MT20	7.0	8.0		Edge
F	TMWV-t	MT20	5.0	6.0		
G	TMWV-p	MT20	6.0	12.0	1.50	Edge
H	BMV1-t	MT20	5.0	6.0		Edge 0.50
I	BMWV-t	MT20	7.0	8.0		4.25 2.00
J	BMWV-t	MT20	5.0	6.0		4.25 2.50
K	BMWVW-t	MT20	5.0	6.0		
L	BS-t	MT20	5.0	6.0		
M	BMWV-t	MT20	5.0	6.0		4.25 2.50
N	BMWV-t	MT20	7.0	8.0		4.25 2.00
O	BMV1-t	MT20	5.0	6.0		5.50

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)


JT	LOC.	LC1	MAX	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
T	9-8-4	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
U	11-0-12	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
V	13-0-12	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
W	15-0-12	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
X	17-0-12	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
Y	19-0-12	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
Z	21-0-12	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
AA	23-0-12	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
AB	25-0-12	-1571	-1571	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2008017 4/2

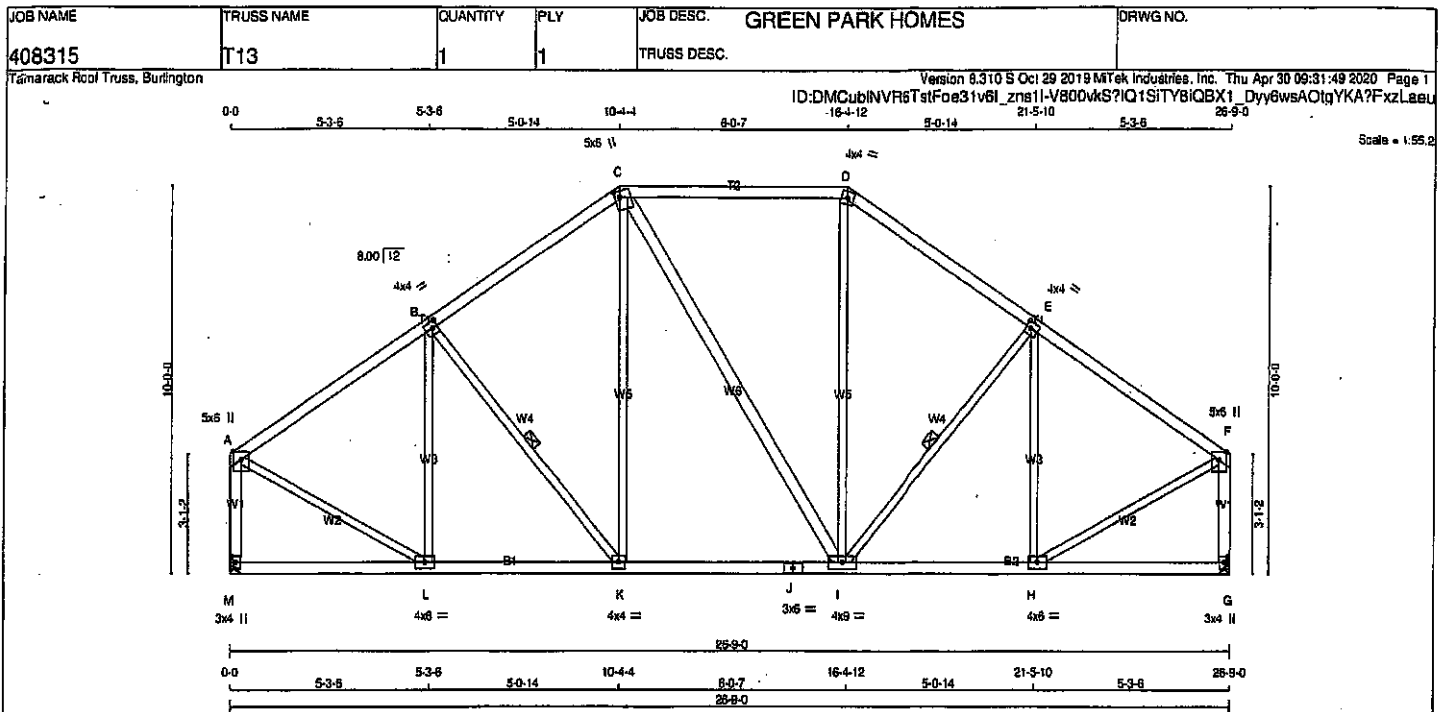

TOTAL WEIGHT = 132 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DESCR.
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
M - A	2x4	DRY	No.2
G - F	2x4	DRY	No.2
M - J	2x4	DRY	No.2
J - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT	2x4	DRY	No.2
C - I			

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMVW+p	MT20	5.0	6.0 Edge
S	TMVW-t	MT20	4.0	4.0 2.00 1.50
C	TTWW+m	MT20	5.0	6.0 2.00 1.50
D	TTWW-m	MT20	4.0	4.0
E	TMVW-t	MT20	4.0	4.0 2.00 1.50
F	TMVW+p	MT20	5.0	6.0 Edge
G	BMV1+p	MT20	3.0	4.0
H	BMVW-t	MT20	4.0	6.0
I	BMVW-t	MT20	4.0	9.0
J	BS-t	MT20	3.0	6.0
K	BMVW-t	MT20	4.0	4.0
L	BMVW-t	MT20	4.0	6.0
M	BMV1+p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
M	1475	0	1475	0	0
G	1475	0	1475	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT M, G. MINIMUM BEARING LENGTH AT JOINT M = 3-8, JOINT G = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
M	1043	684 / 0	0 / 0	0 / 0	0 / 0	358 / 0	0 / 0
G	1043	684 / 0	0 / 0	0 / 0	0 / 0	358 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.39 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF B-K, E-I.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	-1227 / 0	L-B	-445 / 0
B-C	-1198 / 0	B-K	-124 / 0
C-D	-971 / 0	K-C	0 / 197
D-E	-1199 / 0	C-I	0 / 0
E-F	-1227 / 0	I-D	0 / 198
M-A	-1434 / 0	F-E	-124 / 0
G-F	-1434 / 0	H-E	-445 / 0
		A-L	0 / 1183
		H-F	0 / 1183
M-L	0 / 0		
L-K	0 / 1047		
K-J	0 / 971		
J-I	0 / 971		
I-H	0 / 1047		
H-G	0 / 0		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.89")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.04")
ALLOWABLE DEFL.(TL) = $L/360$ (0.89")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.08")

CSI: $TC=0.44/1.00$ (C-D:1), $BC=0.23/1.00$ (H-I:1),
 $WB=0.32/1.00$ (E-H:1), $SSI=0.22/1.00$ (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX	MIN	MAX
MT20	818	354
	1667	788
	1987	1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.69 (A) (INPUT = 0.90)
JSI METAL = 0.50 (A) (INPUT = 1.00)

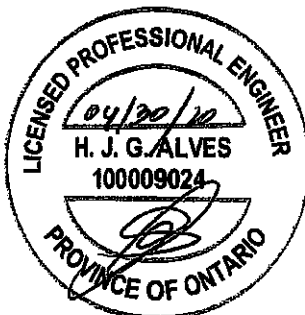


Structural component only
DWG# T-2008018

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	T14S	1	1	GREEN PARK HOMES	
TRUSS DESC.					

Tegranack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 09:31:50 2020 Page 1
ID:DMCubINVREtsiFoe31v6l_zns1l-zKaO64Td3j9JkC7KG8jmaBm6aWFlvsdqn_wZnNzLaet

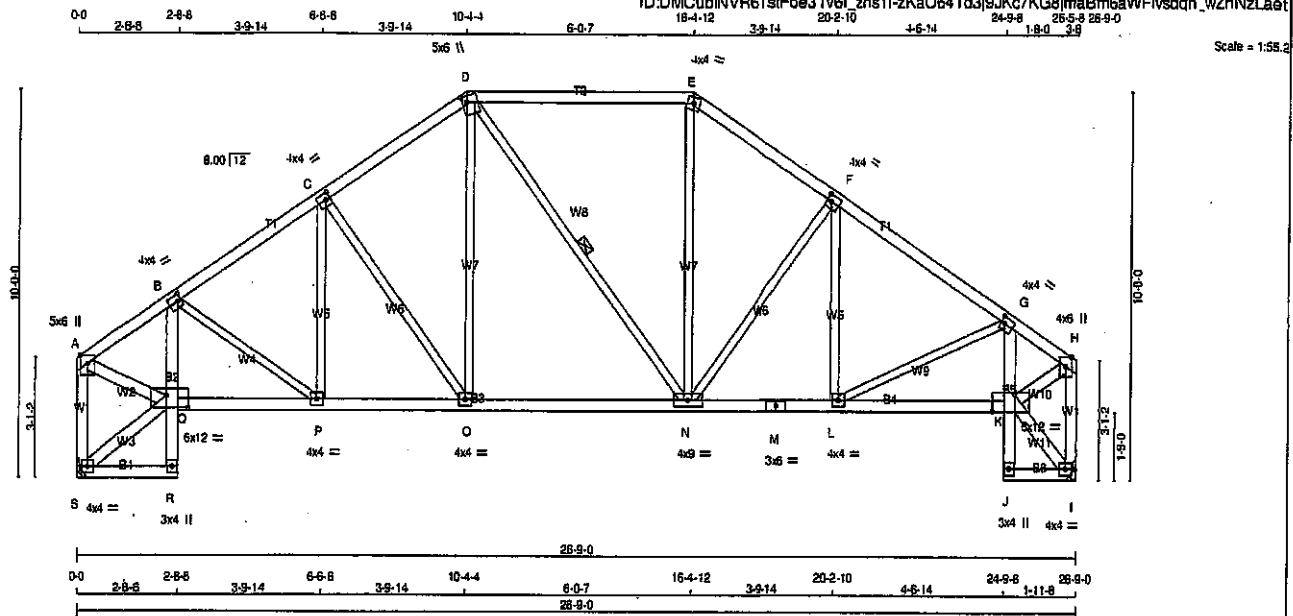

TOTAL WEIGHT = 138 lb
[M/F]

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - H	2x4	DRY	No.2
S - A	2x4	DRY	No.2
I - H	2x4	DRY	No.2
S - R	2x4	DRY	No.2
R - B	2x4	DRY	No.2
Q - M	2x4	DRY	No.2
M - K	2x4	DRY	No.2
@ - G	2x4	DRY	No.2
J - I	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
S - Q	2x4	DRY	No.2
A - Q	2x4	DRY	No.2
K - I	2x4	DRY	No.2
K - H	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+P	MT20	5.0	6.0	Edge	
B	TMVW+T	MT20	4.0	4.0	2.00	1.00
C	TMVW+T	MT20	4.0	4.0	2.00	1.50
D	TTWW+m	MT20	5.0	6.0	2.00	1.50
E	TTW-m	MT20	4.0	4.0		
F	TMVW+T	MT20	4.0	4.0	2.00	1.50
G	TMVW+T	MT20	4.0	4.0	2.00	1.00
H	TMVW+P	MT20	4.0	6.0	Edge	
I	BMVW+T	MT20	4.0	4.0		
J	BMV+P	MT20	3.0	4.0		
K	BMVW+T	MT20	6.0	12.0	5.25	7.25
L	BMVW+T	MT20	4.0	4.0		
M	BS+T	MT20	3.0	6.0		
N	BMVW+T	MT20	4.0	9.0		
Q	BMVW+T	MT20	6.0	12.0	3.75	7.00
R	BMV+P	MT20	3.0	4.0		
S	BMVW+T	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	GROSS REACTION	VERT	HORZ	DOWN	BRG
S	1475	0	1475	0	0
I	1475	0	1475	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT S, I. MINIMUM BEARING LENGTH AT JOINT S = 3'-8", JOINT I = 3'-8".

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	1043	884 / 0	0 / 0	0 / 0	0 / 0	0 / 0	358 / 0	0 / 0
I	1043	884 / 0	0 / 0	0 / 0	0 / 0	0 / 0	358 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.94 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF D-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORZ. LOAD (LBS)
FR-TO			
A-B	-1511 / 0	-91.8	-91.8 0.11 (1)
B-C	-1853 / 0	-91.8	-91.8 0.19 (1)
C-D	-1440 / 0	-91.8	-91.8 0.18 (1)
D-E	-1184 / 0	-91.8	-91.8 0.45 (1)
E-F	-1445 / 0	-91.8	-91.8 0.21 (1)
F-G	-1684 / 0	-91.8	-91.8 0.22 (1)
G-H	-1355 / 0	-91.8	-91.8 0.14 (1)
S-A	-1442 / 0	0.0	0.0 0.24 (1)
I-H	-1444 / 0	0.0	0.0 0.24 (1)
S-R	0 / 13	-18.5	-18.5 0.04 (4)
R-Q	0 / 27	0.0	0.0 0.03 (1)
Q-B	-460 / 0	0.0	0.0 0.03 (1)
O-P	0 / 1280	-18.5	-18.5 0.25 (1)
P-O	0 / 1383	-18.5	-18.5 0.28 (1)
O-N	0 / 1184	-18.5	-18.5 0.25 (1)
N-M	0 / 1390	-18.5	-18.5 0.28 (1)
M-L	0 / 1390	-18.5	-18.5 0.28 (1)
L-K	0 / 1189	-18.5	-18.5 0.24 (1)
J-K	0 / 19	0.0	0.0 0.04 (1)
K-G	-613 / 0	0.0	0.0 0.03 (1)
J-I	0 / 15	-18.5	-18.5 0.02 (4)
B-P	0 / 124	0.03	0.03 (1)
P-C	0 / 55	0.02	0.02 (4)
C-O	-345 / 0	0.28	0.28 (1)
O-D	0 / 375	0.08	0.08 (1)
D-N	0 / 0	0.00	0.00 (1)
N-E	0 / 383	0.09	0.09 (1)
E-F	-357 / 0	0.29	0.29 (1)
F-G	-24 / 54	0.02	0.02 (4)
G-H	0 / 244	0.05	0.05 (1)
H-I	-16 / 0	0.00	0.00 (1)
I-J	0 / 1370	0.22	0.22 (1)
J-K	-20 / 0	0.00	0.00 (1)
K-H	0 / 1330	0.21	0.21 (1)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL = 6.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.4	PSF	
TOTAL LOAD = 39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.89")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.89")
CALCULATED VERT. DEFL.(TL) = L/999 (0.10")

CSK: TC=0.45/1.00 (D-E:1), 6C=0.28/1.00 (L-N:1),
WB=0.29/1.00 (F-N:1), SS=0.22/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1697 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (G) (INPUT = 0.90)
JSI METAL = 0.84 (H) (INPUT = 1.00)

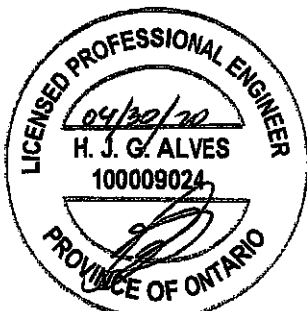

Structural component only
DWG# T-2008019




TOTAL WEIGHT = 132 lb

Structural component only
DWG# T-2007993

JOB NAME 408315	TRUSS NAME T16	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 09:31:52 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns11-wj8XIUblC0ZwhjNYIeforX1JyQNa77FIPtsGzLaer

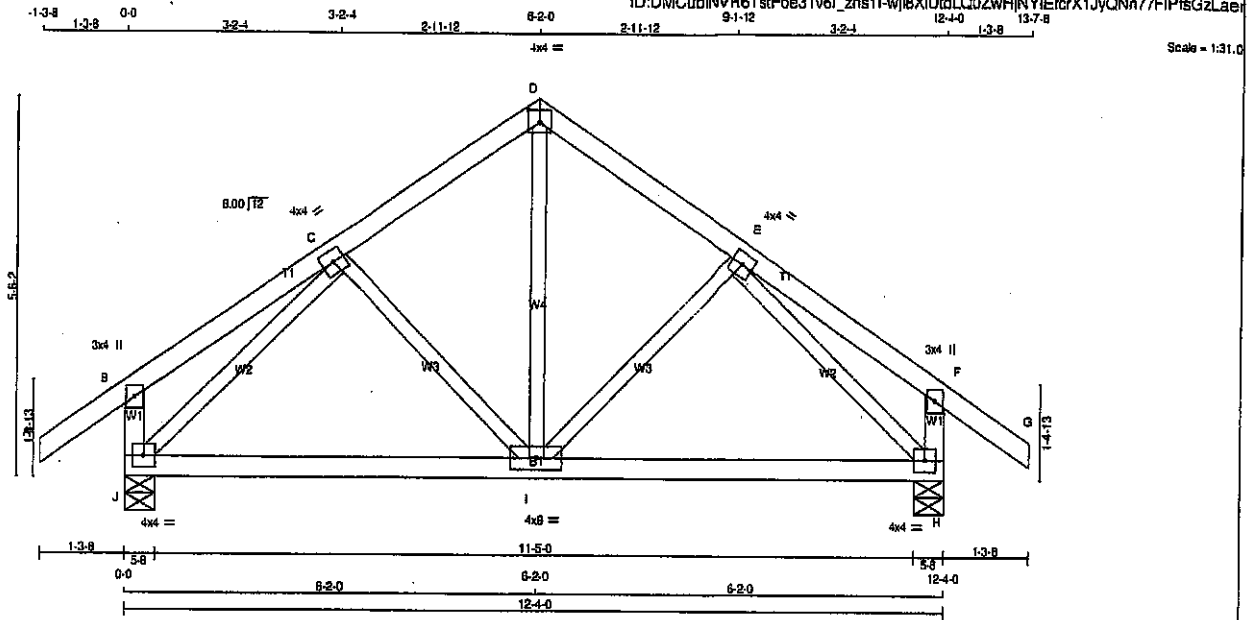

TOTAL WEIGHT = 54 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - G	2x4	DRY No.2	SPF
J - B	2x4	DRY No.2	SPF
H - F	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF

EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV-p	MT20	3.0	4.0		
C	TMWW-1	MT20	4.0	4.0		
D	TTW-p	MT20	4.0	4.0	2.25	2.00
E	TMWW-1	MT20	4.0	4.0		
F	TMV-p	MT20	3.0	4.0		
H	BMVW1-1	MT20	4.0	4.0		
I	BMVWW1-1	MT20	4.0	9.0		
J	BMVW1-1	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
J	806	0	806	0
H	806	0	806	0

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
J	568	366 / 0	0 / 0	0 / 0	182 / 0	0 / 0
H	568	366 / 0	0 / 0	0 / 0	182 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNSHORED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8 -91.8 0.12 (1)	10.00	I-D	0 / 337	0.08 (1)	
B-C	0 / 17	-91.8 -91.8 0.13 (1)	10.00	I-E	-139 / 0	0.04 (1)	
C-D	-521 / 0	-91.8 -91.8 0.10 (1)	6.25	C-I	-139 / 0	0.04 (1)	
D-E	-521 / 0	-91.8 -91.8 0.10 (1)	6.25	J-C	-737 / 0	0.23 (1)	
E-F	0 / 17	-91.8 -91.8 0.13 (1)	10.00	E-H	-737 / 0	0.23 (1)	
F-G	0 / 35	-91.8 -91.8 0.12 (1)	10.00				
J-B	-236 / 0	0.0 0.0 0.02 (1)	7.81				
H-F	-236 / 0	0.0 0.0 0.02 (1)	7.81				
J-I	0 / 517	-18.5 -18.5 0.24 (4)	10.00				
I-H	0 / 517	-18.5 -18.5 0.24 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8 PSF
DL = 8.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $\frac{1}{360}$ (0.41")
CALCULATED VERT. DEFL.(LL) = $\frac{1}{999}$ (0.01")
ALLOWABLE DEFL.(TL) = $\frac{1}{360}$ (0.41")
CALCULATED VERT. DEFL.(TL) = $\frac{1}{999}$ (0.04")

CSI: TC=0.13/1.00 (B-C:1), BC=0.24/1.00 (H-I:4),
WB=0.23/1.00 (C-J:1), SSI=0.11/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.68 (E) (INPUT = 0.90)
JSI METAL= 0.26 (E) (INPUT = 1.00)




Structural component only
DWG# T-2008020

JOB NAME 408315	TRUSS NAME G16	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 09:31:16 2020 Page 1
ID:DMCubiNVR6TstFoe31v6l_zns1l-znVXzR3i3H7EOXoG75oB0MCHpiPxyqzghibLzLafF

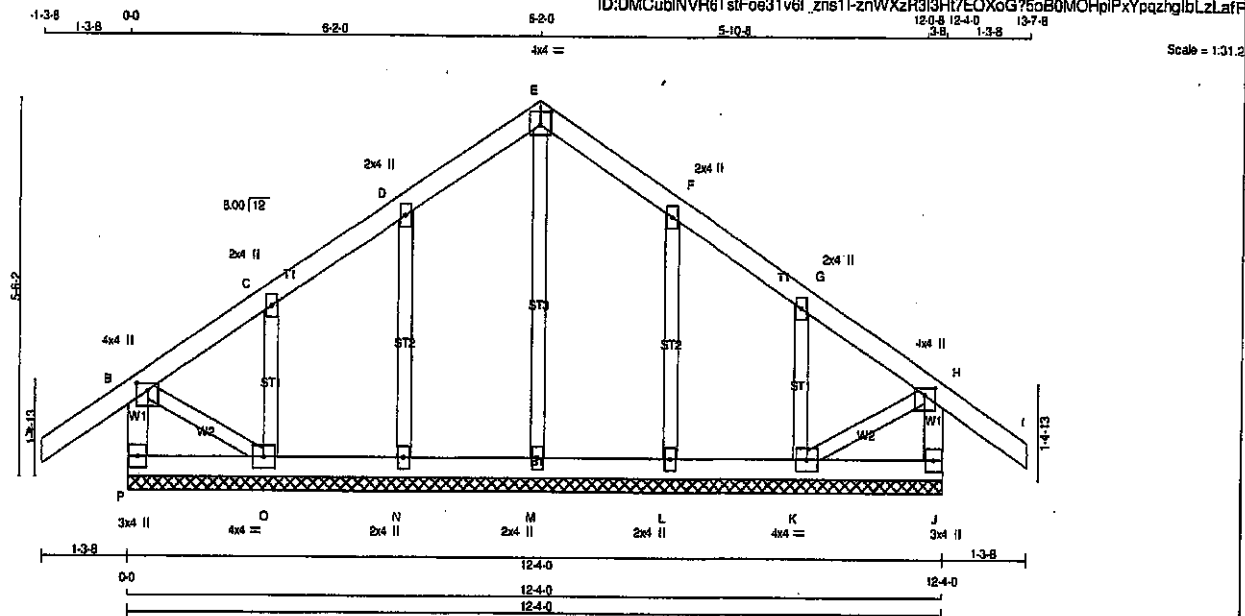

TOTAL WEIGHT = 54 lb [M]

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
P - B	2x4	DRY	No.2	SPF
A - E	2x4	DRY	No.2	SPF
E - I	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
P - J	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
ALL GABLE WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMW+p	MT20	4.0	4.0	1.25	2.00
C, D, F, G					
C TMW+w	MT20	2.0	4.0		
D TTW+p	MT20	4.0	4.0	2.25	2.00
H TMW+p	MT20	4.0	4.0	1.25	2.00
J BMV1+p	MT20	3.0	4.0		
K BMW1-i	MT20	4.0	4.0		
L, M, N					
L BMW1+w	MT20	2.0	4.0		
O BMW1-i	MT20	4.0	4.0		
P BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (LC)	MAX. UNBRAC LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRAC LENGTH (FT)
FR-TO		FROM TO			FR-TO		
P-B	-232 / 0	0.0	0.0 0.02 (1)	7.81	M-E	-137 / 0	0.06 (1)
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	N-D	-202 / 0	0.05 (1)
B-C	-19 / 0	-91.8	-91.8 0.05 (1)	6.25	O-C	-202 / 0	0.03 (1)
C-D	-22 / 0	-91.8	-91.8 0.05 (1)	6.25	L-F	-202 / 0	0.05 (1)
D-E	-27 / 0	-91.8	-91.8 0.05 (1)	6.25	K-G	-202 / 0	0.03 (1)
E-F	-27 / 0	-91.8	-91.8 0.05 (1)	6.25	B-O	0 / 28	0.01 (1)
F-G	-22 / 0	-91.8	-91.8 0.05 (1)	6.25	K-H	0 / 28	0.01 (1)
G-H	-19 / 0	-91.8	-91.8 0.05 (1)	6.25			
H-I	0 / 35	-91.8	-91.8 0.12 (1)	10.00			
J-H	-232 / 0	0.0	0.0 0.02 (1)	7.81			
P-O	0 / 0	-18.5	-18.5 0.02 (4)	10.00			
O-N	0 / 18	-18.5	-18.5 0.02 (4)	10.00			
N-M	0 / 14	-18.5	-18.5 0.02 (4)	10.00			
M-L	0 / 14	-18.5	-18.5 0.02 (4)	10.00			
L-K	0 / 18	-18.5	-18.5 0.02 (4)	10.00			
K-J	0 / 0	-18.5	-18.5 0.02 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2016

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (H-I:1), BC=0.02/1.00 (K-L:4), WB=0.08/1.00 (E-M:1), SI=0.08/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	MAX MIN	MAX MIN	MAX MIN
	818 354	1987 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.80)
JSI METAL= 0.10 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007994

JOB NAME 408315	TRUSS NAME T17	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 09:31:53 2020 Page 1
ID:DMCubINVH6TsIF0e31v6l_znsT1-OvFKk5VVMeYIB4\$wxGGTBQCaNjHr643GTy8DOizLaec

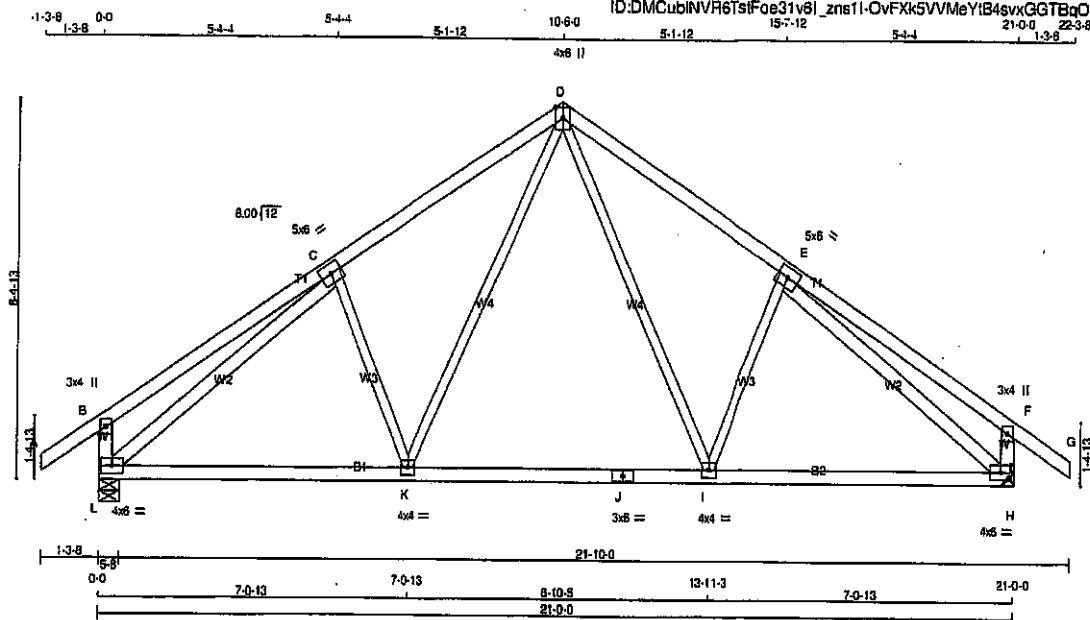

Scale = 1:47.2

LUMBER	N.L.G.A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
L - B	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
J - J	2x4	DRY	No.2	SPF	
L - H	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
L - C	2x4	DRY	No.2	SPF	
E - H	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-t	MT20	5.0	6.0		
D	TTWW+p	MT20	4.0	6.0		Edge
E	TMVW-t	MT20	5.0	6.0		
F	TMV+p	MT20	3.0	4.0		
H	BMVW-t	MT20	4.0	6.0		
I	BMVW-t	MT20	4.0	4.0		
J	BS-t	MT20	3.0	6.0		
K	BMVW-t	MT20	4.0	4.0		
L	BMVW-t	MT20	4.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	IN-SX	IN-SX
L	1284	0	1284	0
H	1284	0	1284	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3'-8".

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
L	905	608 / 0	0 / 0	0 / 0	298 / 0	0 / 0
H	905	608 / 0	0 / 0	0 / 0	298 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.52 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED CS (LC)	MAX. FACTORED UNBRAC LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)
FR-TO	FROM	TO	FROM	TO	FR-TO	FROM	TO	FROM	TO
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	D-I	0 / 475	0.11 (1)	
B-C	0 / 32	-91.8	-91.8	0.42 (1)	10.00	I-E	-321 / 0	0.13 (1)	
C-D	-1155 / 0	-91.8	-91.8	0.34 (1)	5.52	K-D	0 / 475	0.11 (1)	
D-E	-1155 / 0	-91.8	-91.8	0.34 (1)	5.52	C-K	-321 / 0	0.13 (1)	
E-F	0 / 32	-91.8	-91.8	0.42 (1)	10.00	L-C	-1403 / 0	0.89 (1)	
F-G	0 / 35	-91.8	-91.8	0.12 (1)	10.00	E-H	-1403 / 0	0.89 (1)	
L-B	-307 / 0	0.0	0.0	0.03 (1)	7.81				
H-F	-307 / 0	0.0	0.0	0.03 (1)	7.81				
L-K	0 / 1056	-18.5	-18.5	0.29 (4)	10.00				
K-J	0 / 749	-18.5	-18.5	0.27 (4)	10.00				
J-I	0 / 749	-18.5	-18.5	0.27 (4)	10.00				
I-H	0 / 1056	-18.5	-18.5	0.29 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, OSC 2012, ABC 2019
- PART 9 OF OSC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.70")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.04")
ALLOWABLE DEFL. (TL) = $L/360$ (0.70")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.09")

CS: TC=0.42/1.00 (B-C:1), BC=0.29/1.00 (K-L:4), WB=0.89/1.00 (C-L:1), SS=0.19/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PL)	(PL)
MT20	618	354	1987 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.70 (E) (INPUT = 0.90)
JSI METAL=0.36 (E) (INPUT = 1.00)




Structural component only
DWG# T-2008021

JOB NAME 408315	TRUSS NAME T18	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 20 2019 Mitek Industries, Inc. Thu Apr 30 09:31:55 2020 Page 1
ID:DMCubINVR6TsFoe31v6l_zns1I-KINH9nXmuGobQO7H3hkhFT2sXySa6xZxGdKSbzLaoc

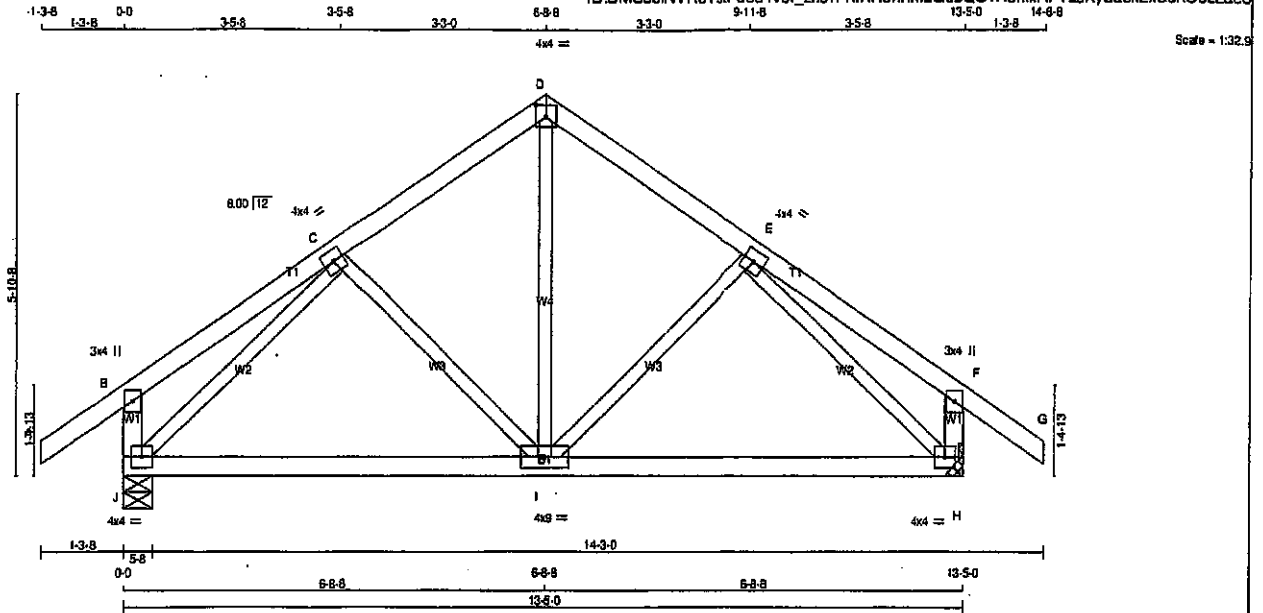

TOTAL WEIGHT = 3 X 58 = 175 lb
(M/JF)

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - G	2x4	DRY No.2	SPF
J - B	2x4	DRY No.2	SPF
H - F	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	4.0		
D	TTW-p	MT20	4.0	4.0	2.25	2.00
E	TMWW-t	MT20	4.0	4.0		
F	TMV+p	MT20	3.0	4.0		
H	BMWW-t	MT20	4.0	4.0		
I	BMWW-t	MT20	4.0	9.0		
J	BMWW-t	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
J	868	0	868	0	5-8
H	868	0	868	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	810	413/0	0/0	0/0	0/0	196/0	0/0
H	810	413/0	0/0	0/0	0/0	196/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0/35	I-D	0/379
B-C	0/19	E-E	-161/0
C-D	-577/0	G-I	-161/0
D-E	-577/0	J-C	-815/0
E-F	0/19	E-H	-815/0
F-G	0/35		
J-B	-245/0		
H-F	-245/0		
J-I	0/579		
I-H	0/579		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN LC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.45")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.45")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.18/1.00 (B-C:1), BC=0.28/1.00 (H-I:4),
WB=0.29/1.00 (C-J:1), SS=0.12/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI)
(PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1659

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.71 (E) (INPUT = 0.90)
JSI METAL = 0.29 (C) (INPUT = 1.00)




Structural component only
DWG# T-2008022

JOB NAME 408315	TRUSS NAME G18	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tannerack Roof Truss, Burlington.

Version 8.310 S Oct 29 2019 MTsk Industries, Inc. Thu Apr 30 09:31:19 2020 Page 1
ID:DMCubINVR6TstFos31v6I_zns11-NMCGt5AMCF6rFny7Vpf_vW0kz8fNGfVOCgzLatM
13-1-8 13-5-0 14-6-8

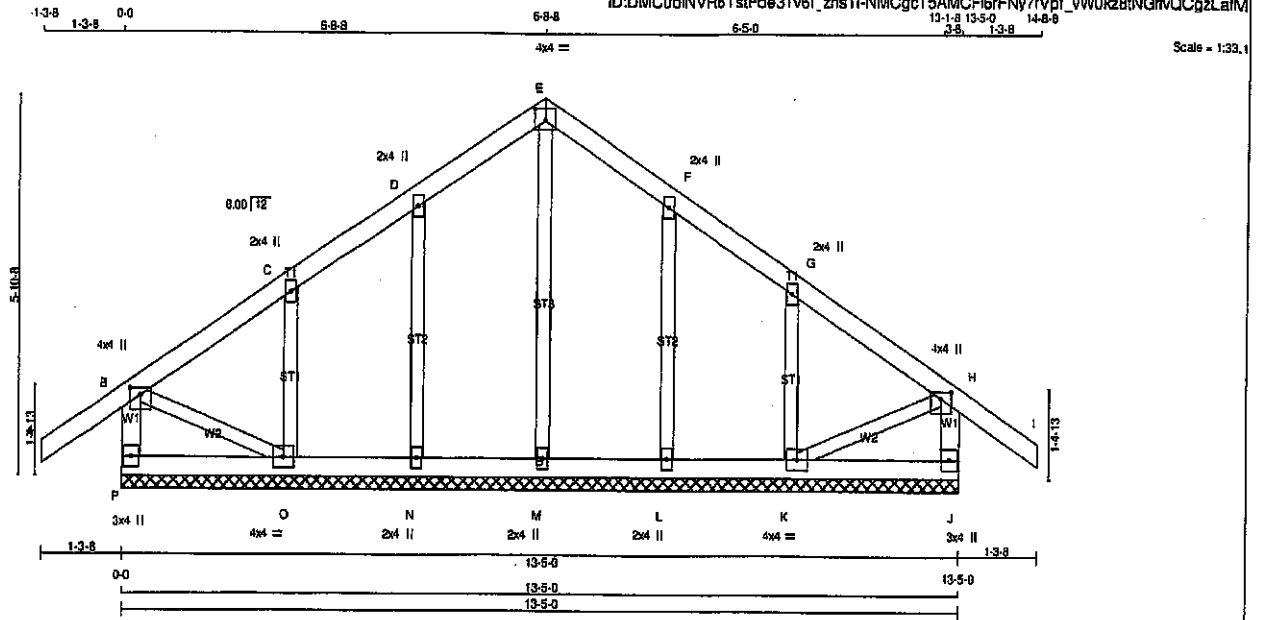

TOTAL WEIGHT = 59 lb

LUMBER

N. L. G. A. RULES

CHORDS SIZE

P - B 2x4 DRY No.2

A - E 2x4 DRY No.2

E - I 2x4 DRY No.2

J - H 2x4 DRY No.2

P - J 2x4 DRY No.2

ALL WEBS 2x3 DRY No.2

ALL GABLE WEBS 2x3 DRY No.2

DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.25	2.00
C, D, F, G					
C TMW+w	MT20	2.0	4.0		
E TTW+p	MT20	4.0	4.0	2.25	2.00
H TMVW+p	MT20	4.0	4.0	1.25	2.00
J BMV1+p	MT20	3.0	4.0		
K BMWV1-i	MT20	4.0	4.0		
L, M, N					
L BMW1+w	MT20	2.0	4.0		
O BMWV1-i	MT20	4.0	4.0		
P BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
P-B	-252 / 0	0.0	0.0 0.03 (1)	M-E	-138 / 0	0.07 (1)	
A-B	0 / 35	-91.8	-91.8 0.12 (1)	N-D	-189 / 0	0.06 (1)	
B-C	-19 / 0	-91.8	-91.8 0.06 (1)	O-C	-241 / 0	0.05 (1)	
C-D	-29 / 0	-91.8	-91.8 0.06 (1)	L-F	-189 / 0	0.06 (1)	
D-E	-27 / 0	-91.8	-91.8 0.05 (1)	K-G	-241 / 0	0.05 (1)	
E-F	-27 / 0	-91.8	-91.8 0.05 (1)	B-O	0 / 28	0.01 (1)	
F-G	-29 / 0	-91.8	-91.8 0.06 (1)	K-H	0 / 28	0.01 (1)	
G-H	-18 / 0	-91.8	-91.8 0.06 (1)				
H-I	0 / 35	-91.8	-91.8 0.12 (1)				
J-H	-252 / 0	0.0	0.0 0.03 (1)				
P-O	0 / 0	-18.5	-18.5 0.03 (4)				
O-N	0 / 19	-18.5	-18.5 0.03 (4)				
N-M	0 / 15	-18.5	-18.5 0.02 (4)				
M-L	0 / 15	-18.5	-18.5 0.02 (4)				
L-K	0 / 19	-18.5	-18.5 0.03 (4)				
K-J	0 / 0	-18.5	-18.5 0.03 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, NBC 2012, ABC 2019

- PART 9 OF NBC 2012 (2019 AMENDMENT)

- CSA 086-09, CSA 086-14

- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (H:1), BC=0.03/1.00 (N:0.4)

WB=0.07/1.00 (E-M:1), SS=0.09/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MT20 618 354 1667 788 1987 1668

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.18 (H) (INPUT = 0.90)

JSI METAL= 0.12 (G) (INPUT = 1.00)




Structural component only
DWG# T-2007996

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T18S	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:05:21 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns11-bDbdAio2TcXz4IMqZ_lMaGYr69cWbOmQDMZUIJzLa9S

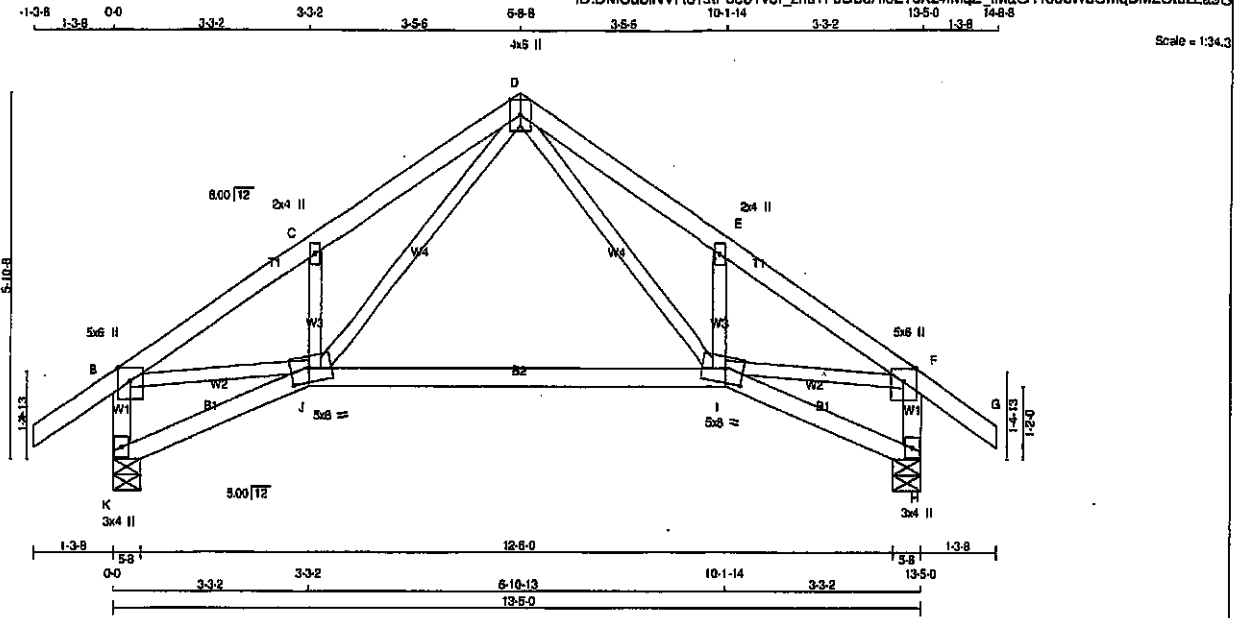

TOTAL WEIGHT = 2 X 57 = 115 lb (MIF)

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
K - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
K - J	2x4	DRY	No.2
J - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMWV+p	MT20	5.0	6.0	Edge
C	TMW+w	MT20	2.0	4.0	
D	TTWV+p	MT20	4.0	6.0	Edge
E	TMW+w	MT20	2.0	4.0	
F	TMWV+p	MT20	5.0	6.0	Edge
H	BMV1+p	MT20	3.0	4.0	
I	BBWWV-m	MT20	5.0	6.0	2.75 3.50
J	BBWWV-m	MT20	5.0	6.0	2.75 3.50
K	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	DOWN	HORZ	UP/LIFT	IN-SX	BRG	IN-SX
K	886	0	886	0	0	5-8	5-8		
H	886	0	886	0	0	5-8	5-8		

UNFACTORED REACTIONS		1ST LCASE		MAX/MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
K	610	413/0	0/0	0/0	0/0
H	610	413/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.84 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING		TOTAL LOAD CASES: (4)	
CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0.35	D-I	0.7823
B-C	-1092/0	E-H	-369/0
C-D	-1130/0	J-D	0.7823
D-E	-1130/0	J-C	-369/0
E-F	-1082/0	B-J	0.7823
F-G	0.35	I-F	0.7823
K-B	-835/0		
H-F	-835/0		
K-J	0/0		
J-I	0.541		
I-H	0/0		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.45")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.45")
CALCULATED VERT. DEFL.(TL) = L/999 (0.15")

CSI: TC=0.13/1.00 (C-D-1), BC=0.30/1.00 (F-J-4), WB=0.21/1.00 (F-I-1), SS=0.12/1.00 (C-D-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR (PLI) SECTION (PSI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1657 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.78 (F) (INPUT = 0.90)
JSI METAL= 0.48 (F) (INPUT = 1.00)




Structural component only
DWG# T-2008027

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	T19	3	1	GREEN PARK HOMES	

Samrack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 09:31:58 2020 Page 1
ID:DMCubiNVR6TstFoe31v6l_zns11-oUxIn7YOeZwS2XaUcOpApS0BfxHDJWdIAwNt?1zLaen

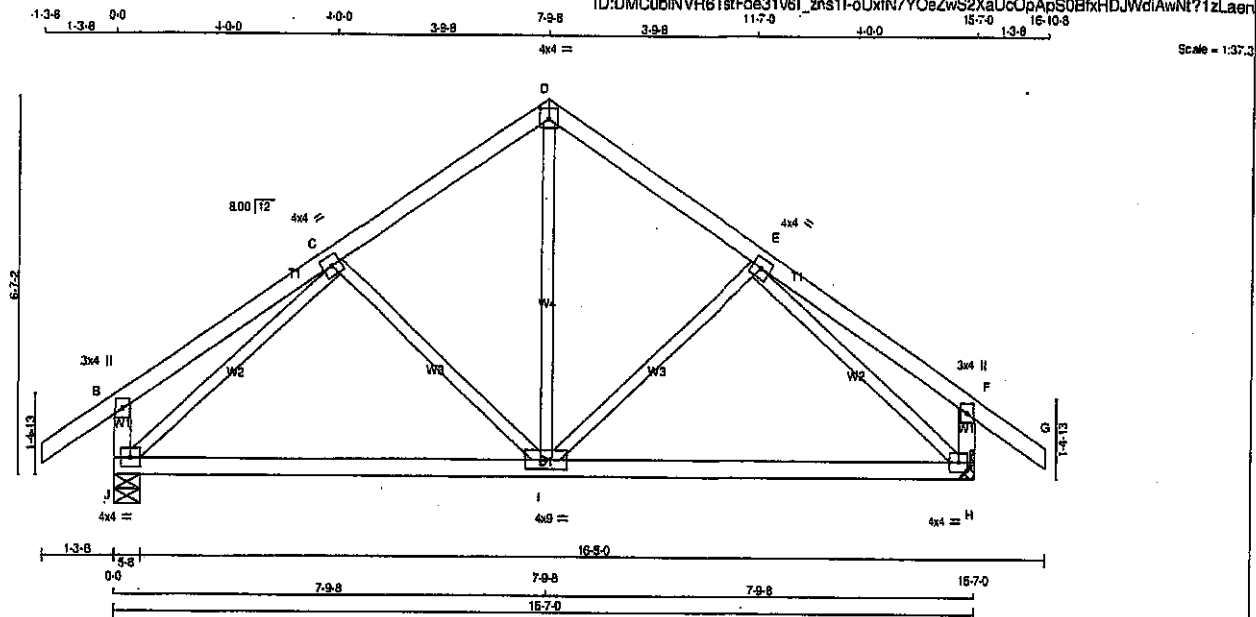

TOTAL WEIGHT = 3 X 66 = 198 lb (M/F)

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
J - B	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV-p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	4.0		
D	TTW-p	MT20	4.0	4.0	2.25	2.00
E	TMWW-t	MT20	4.0	4.0		
F	TMV-p	MT20	3.0	4.0		
H	BMWW-t	MT20	4.0	4.0		
I	BMWW-t	MT20	4.0	9.0		
J	BMWW-t	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ
J	985	0	985	0
H	985	0	985	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3x8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS	PERM	LIVE	WIND	DEAD	SOIL
J	894	469 / 0	0 / 0	0 / 0	0 / 0	0 / 0	225 / 0	0 / 0
H	894	469 / 0	0 / 0	0 / 0	0 / 0	0 / 0	225 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED	WEBS
MEMB.	FORCE (LBS)	VERT. (PLF)	CS1 (LC)	UNBRAC	LENGTH	FR-TO	MEMB.	FORCE (LBS)	CS1 (LC)
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	I-D	0 / 463	0.10 (1)	
B-C	0 / 23	-91.8	-91.8	0.22 (1)	10.00	I-E	-208 / 0	0.10 (1)	
C-D	-689 / 0	-91.8	-91.8	0.17 (1)	6.25	C-I	-208 / 0	0.10 (1)	
D-E	-689 / 0	-91.8	-91.8	0.17 (1)	6.25	J-C	-971 / 0	0.45 (1)	
E-F	0 / 23	-91.8	-91.8	0.22 (1)	10.00	E-H	-971 / 0	0.45 (1)	
F-G	0 / 35	-91.8	-91.8	0.12 (1)	10.00				
J-B	-263 / 0	0.0	0.0	0.03 (1)	7.81				
H-F	-263 / 0	0.0	0.0	0.03 (1)	7.81				
J-I	0 / 706	-18.5	-18.5	0.38 (4)	10.00				
I-H	0 / 706	-18.5	-18.5	0.38 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
DL	=	6.0	PSF	
BOT CH.	LL	=	0.0	PSF
DL	=	7.4	PSF	
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.52")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.02")
ALLOWABLE DEFL.(TL) = $L/360$ (0.52")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.09")

CSI: TC=0.22/1.00 (B-C:1), EC=0.38/1.00 (I-J:4), WB=0.45/1.00 (C-J:1), SSI=0.14/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1687
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.82 (J) (INPUT = 0.90)
JSI METAL= 0.34 (E) (INPUT = 1.00)




Structural component only
DWG# T-2008023

JOB NAME 408315	TRUSS NAME T20S	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 09:31:57 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-GgV1aTY0Pi2Jh9gA6LPmYLeKe720asOa6QXTzLaem

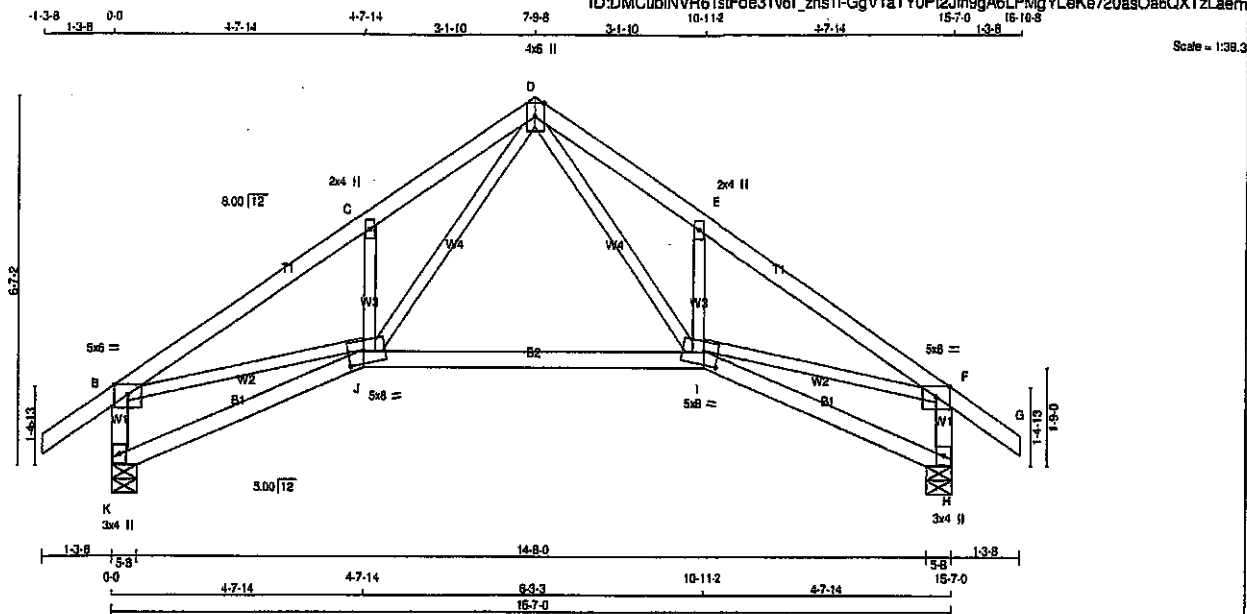

TOTAL WEIGHT = 2 X 65 = 132 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
K - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
K - J	2x4	DRY	No.2
J - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JF TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	6.0 Edge
C	TMW-w	MT20	2.0	4.0
D	TTWW-p	MT20	4.0	6.0 Edge
E	TMW-w	MT20	2.0	4.0
F	TMVW-p	MT20	5.0	6.0 Edge
H	BMV1-p	MT20	3.0	4.0
I	BBWWW-m	MT20	5.0	8.0 2.75 3.25
J	BBWWW-m	MT20	5.0	8.0 2.75 3.25
K	BMV1-p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT		RECORD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX	BRG
K	985	0	985	0	0	5-8	5-8	5-8	5-8
H	985	0	985	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LOASE	MAX/MIN. COMPONENT REACTIONS	LIVE	PERM.LIVE	WIND	DEAD	SOIL
K	694	469 / 0	0 / 0	0 / 0	0 / 0	225 / 0	0 / 0
H	694	469 / 0	0 / 0	0 / 0	0 / 0	225 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.16 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8 -91.8	0.12 (1)	10.00	D-I	0 / 880	0.20 (1)
B-C	-1445 / 0	-91.8 -91.8	0.27 (1)	5.16	E	-445 / 0	0.08 (1)
C-D	-1497 / 0	-91.8 -91.8	0.19 (1)	5.16	J-D	0 / 880	0.20 (1)
D-E	-1497 / 0	-91.8 -91.8	0.19 (1)	5.16	J-E	-445 / 0	0.08 (1)
E-F	-1445 / 0	-91.8 -91.8	0.27 (1)	5.16	B-J	0 / 1231	0.28 (1)
F-G	0 / 35	-91.8 -91.8	0.12 (1)	10.00	I-F	0 / 1231	0.28 (1)
K-B	-942 / 0	0.0	0.0	10.0 (1)			
H-F	-942 / 0	0.0	0.0	10.0 (1)			
K-J	0 / 0	-18.5 -18.5	0.12 (4)	10.00			
J-I	0 / 721	-18.5 -18.5	0.27 (4)	10.00			
I-H	0 / 0	-18.5 -18.5	0.12 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 8 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.52")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.52")
CALCULATED VERT. DEFL.(TL) = L/999 (0.16")

CSI: TC=0.27/1.00 (B-C:1), BC=0.27/1.00 (I-J:4),
WB=0.28/1.00 (F-I:1), SI=0.18/1.00 (B-C:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 785 1887 1856

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.69 (F) (INPUT = 0.90)
JSI METAL= 0.30 (I) (INPUT = 1.00)




Structural component only
DWG# T-2008024

JOB NAME 408316	TRUSS NAME T20S1	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	----------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:06:22 2020 Page 1
ID:DMCubINVR6TstFoa31v6l_zns11-3P80C2pgEvgjpx07hpb6U5?cZylKqHzR01PmzLa9R

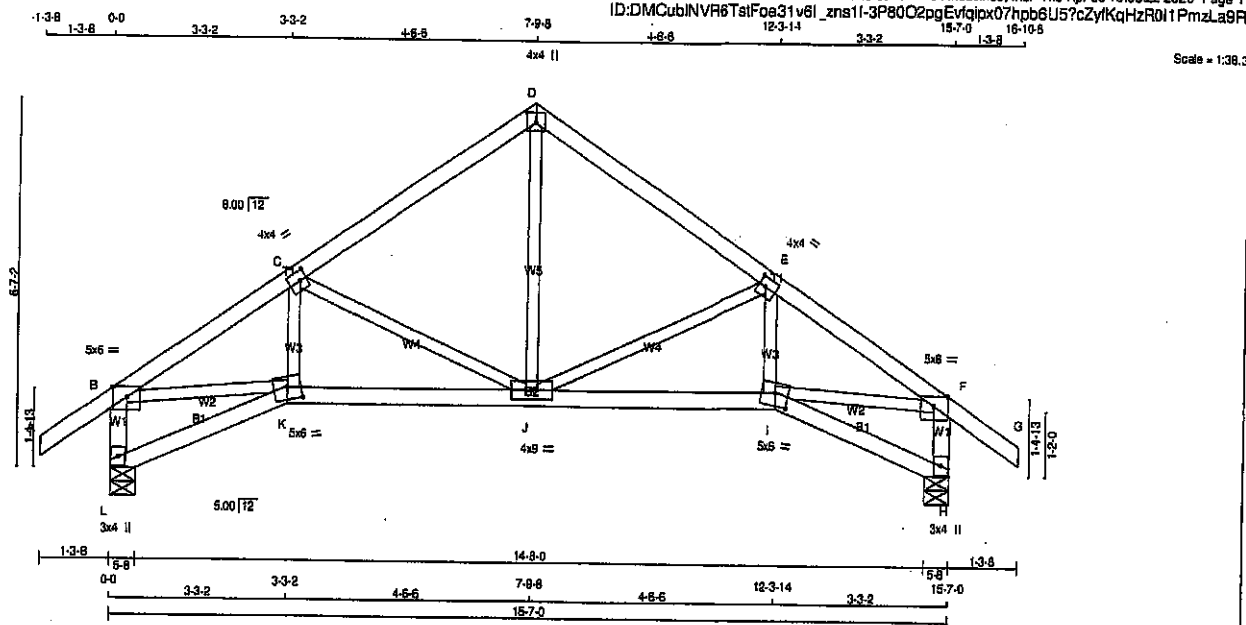

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
L - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVV-p	MT20	5.0	6.0	Edge	
C	TMVV-w	MT20	4.0	4.0	2.00	1.50
D	TTW-p	MT20	4.0	4.0	2.25	2.00
E	TMVV-w	MT20	4.0	4.0	2.00	1.50
F	TMVV-p	MT20	5.0	6.0	Edge	
H	BMV1-p	MT20	3.0	4.0		
I	BBWW-m	MT20	5.0	6.0	2.75	3.00
J	BBWW-w	MT20	4.0	9.0		
K	BBWW-m	MT20	5.0	6.0	2.75	3.00
L	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	RECORD
	VERT	HORZ	DOWN	HORZ
JT	985	0	985	0
L	985	0	985	0
H	985	0	985	0

UNFACTORED REACTIONS

	1ST LOASE	MAX/MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
L	894	489 / 0	0 / 0	0 / 0	0 / 0	225 / 0	0 / 0
H	894	489 / 0	0 / 0	0 / 0	0 / 0	225 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.41 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MEMB.	MAX. FACTORED FORCE (LBS)	MAX	LC1
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	J-D	0 / 551	0.12 (1)
B-C	-1334 / 0	-91.8	-91.8 0.19 (1)	5.41	J-E	-516 / 0	0.21 (1)
C-D	-818 / 0	-91.8	-91.8 0.21 (1)	6.25	I-E	0 / 95	0.03 (4)
D-E	-818 / 0	-91.8	-91.8 0.21 (1)	6.25	C-J	-516 / 0	0.21 (1)
E-F	-1334 / 0	-91.8	-91.8 0.19 (1)	5.41	K-C	0 / 95	0.03 (4)
F-G	0 / 35	-91.8	-91.8 0.12 (1)	10.00	B-K	0 / 1132	0.25 (1)
L-B	-955 / 0	0.0	0.0 0.10 (1)	7.81	I-F	0 / 1132	0.25 (1)
H-F	-955 / 0	0.0	0.0 0.10 (1)	7.81			
L-K	0 / 0	-18.5	-18.5 0.06 (4)	10.00			
K-J	0 / 1127	-18.5	-18.5 0.24 (1)	10.00			
J-I	0 / 1127	-18.5	-18.5 0.24 (1)	10.00			
I-H	0 / 0	-18.5	-18.5 0.06 (4)	10.00			

TOTAL WEIGHT = 2 X 66 = 132 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.52")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.03")
ALLOWABLE DEFL.(TL) = $L/360$ (0.52")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.06")

CSI: TC=0.21/1.00 (D-E:1), BC=0.24/1.00 (J-K:1),
WB=0.25/1.00 (B-K:1), SS=0.18/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1626

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.74 (D) (INPUT = 0.90)
JSI METAL = 0.27 (I) (INPUT = 1.00)




Structural component only
DWG# T-2008028

JOB NAME 408315	TRUSS NAME T21	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:59 2020 Page 1
ID:DMCubINVR6TstFos31v6I_zns1-D3do78aGxU1v7J3IXNtR5ea78DeWnG8sbXbMzLaek
14-4-12 14-7-8 14-11-0
2/12 3-8
Scale = 1:23.0

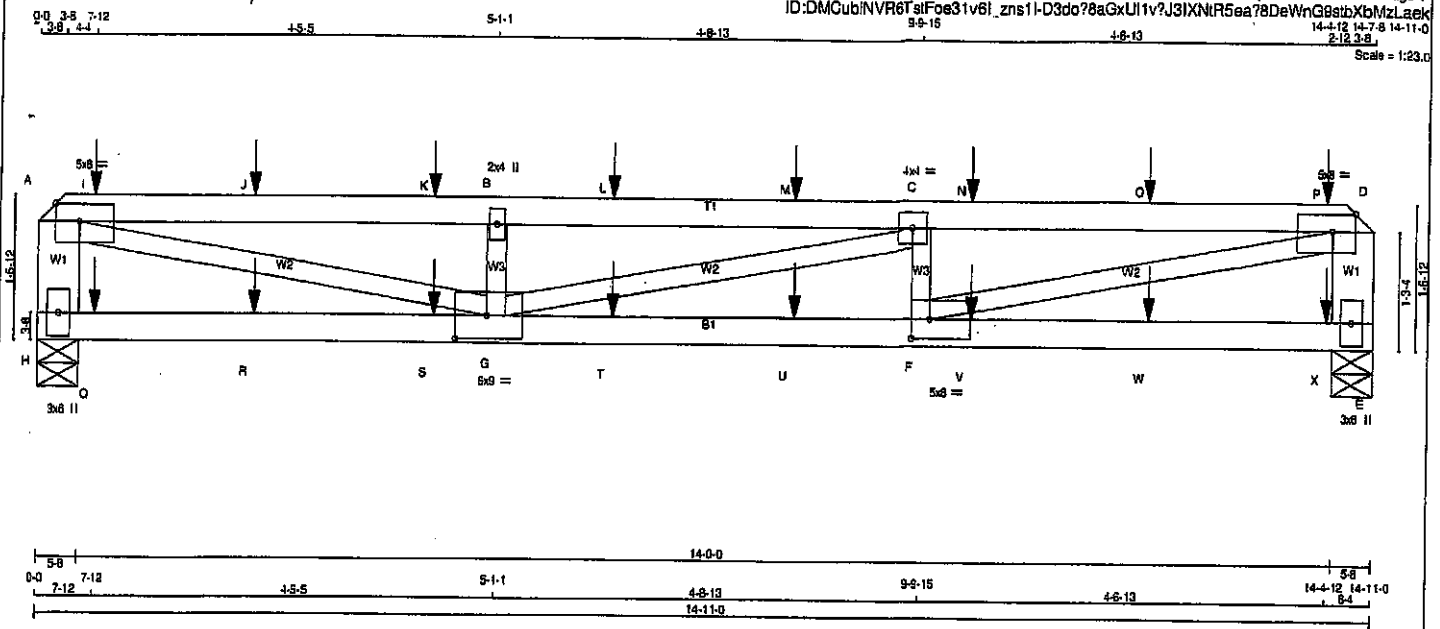

LUMBER				DESIGN CRITERIA			
N. L. G. A. RULES				SPECIFIED LOADS:			
CHORDS	SIZE	LUMBER	DESCR.	TOP CH.	LL	25.8	PSF
A - D	2x4	DRY	No.2	BOT CH.	LL	0.0	PSF
H - A	2x6	DRY	No.2	DL	DL	7.4	PSF
E - D	2x6	DRY	No.2	TOTAL LOAD		39.0	PSF
H - E	2x4	DRY	No.2				
ALL WEBS 2x3 DRY No.2				SPACING = 24.0 IN. C/C			
DRY: SEASONED LUMBER.				LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12			

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	5.0	8.0	Edge	3.25
B	TMVW-w	MT20	2.0	4.0		
C	TMVW-1	MT20	4.0	4.0		
D	TMVW-1	MT20	5.0	8.0	Edge	3.25
E	BMV1-p	MT20	3.0	6.0		
F	BMVW-1	MT20	5.0	8.0	2.50	2.50
G	BMVW-w	MT20	6.0	9.0	3.00	4.25
H	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
H	1220	0	1220	0	5-8
E	1224	0	1224	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	883	568/0	0/0	0/0	0/0	0/0	297.0	0/0
E	855	568/0	0/0	0/0	0/0	0/0	297.0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.06 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.


LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-I	-3296/0	F-D	0/3399
I-J	-3296/0	A-G	0/3397
J-K	-3296/0	F-G	-630/0
K-B	-3296/0	G-B	-632/0
B-L	-3296/0	C-C	0/7
L-M	-3296/0		
M-C	-3296/0		
C-N	-3296/0		
N-O	-3296/0		
O-P	-3296/0		
P-D	-3296/0		
H-A	-1113/0		
E-D	-1116/0		
H-Q	0/0		
Q-R	0/0		
R-S	0/0		
S-G	0/0		
G-T	0/3289		
T-U	0/3289		
U-F	0/3289		
F-V	0/0		
V-W	0/0		
W-X	0/0		
X-E	0/0		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
I	7-12	-71	-71	FRONT	VERT	TOTAL	--	C1
J	2-4-12	-54	-54	FRONT	VERT	TOTAL	--	C1
K	4-4-12	-54	-54	FRONT	VERT	TOTAL	--	C1
L	6-4-12	-54	-54	FRONT	VERT	TOTAL	--	C1
M	8-4-12	-54	-54	FRONT	VERT	TOTAL	--	C1
N	10-4-12	-54	-54	FRONT	VERT	TOTAL	--	C1
O	12-4-12	-54	-54	FRONT	VERT	TOTAL	--	C1
P	14-4-12	-76	-76	FRONT	VERT	TOTAL	--	C1
Q	7-12	-43	-43	FRONT	VERT	TOTAL	--	C1
R	2-4-12	-40	-40	FRONT	VERT	TOTAL	--	C1
S	4-4-12	-40	-40	FRONT	VERT	TOTAL	--	C1
T	6-4-12	-40	-40	FRONT	VERT	TOTAL	--	C1
U	8-4-12	-40	-40	FRONT	VERT	TOTAL	--	C1
V	10-4-12	-40	-40	FRONT	VERT	TOTAL	--	C1
W	12-4-12	-40	-40	FRONT	VERT	TOTAL	--	C1

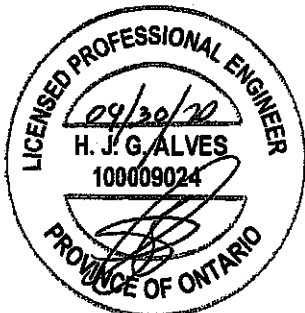

Structural component only
DWG# T-2008025 1/2

CONTINUED ON PAGE 2

JOB NAME 408315	TRUSS NAME T21	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington


Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:59 2020 Page 2
ID:DMCubINVR6TstFoe31v6I zns1I-D3dc78aGxU1v7J3IXNIR5ea78DeWnG9s0XbMzl aek

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
X	14-4-12	-44	-44	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

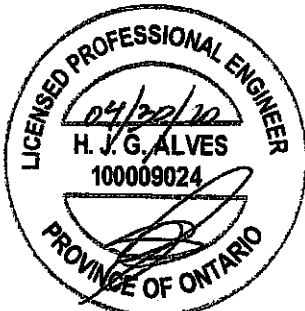


Structural component only
DWG# T-2008025 7/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408316	T30	1	2	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 10:05:23 2020 Page 1
ID:DMCubINVR6TsFoe31v6l_zns1l-XbiObCqJ?DnhKzWChpKqfne9rzDI3Ac7gg2axCzLa9Q
23-2-8 3-10-11 27-1-3 28-11-8 2-8-0 31-7-8 33-0-4 35-1-0 35-4-8
1-3-8 0-0 3-5-8 3-5-8 4-6-5 7-11-13 3-10-11 11-10-8 5-8-0 17-6-8 5-8-0 23-2-8 3-10-11 27-1-3 28-11-8 2-8-0 31-7-8 33-0-4 35-1-0 35-4-8
Scale = 1:50.2

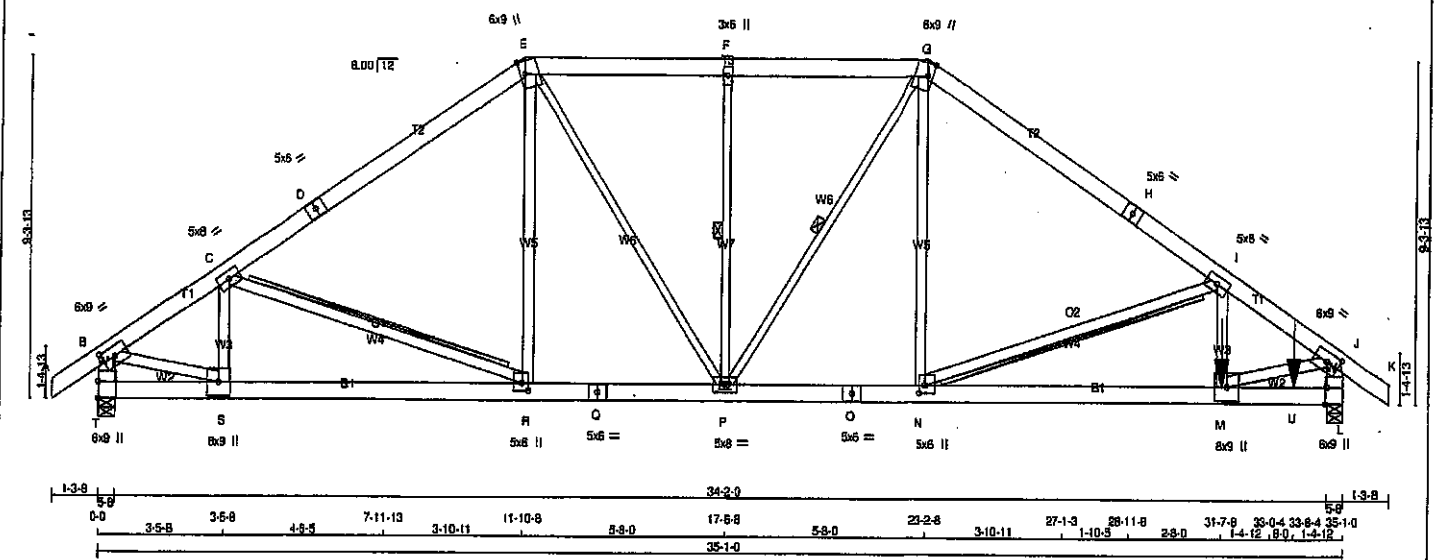

LUMBER	N L G A RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x6 DRY	No.2	SPF		
D - E	2x6 DRY	No.2	SPF		
E - G	2x6 DRY	No.2	SPF		
G - H	2x6 DRY	No.2	SPF		
H - K	2x6 DRY	No.2	SPF		
T - B	2x6 DRY	No.2	SPF		
L - J	2x6 DRY	No.2	SPF		
T - Q	2x6 DRY	No.2	SPF		
Q - O	2x6 DRY	No.2	SPF		
O - L	2x6 DRY	No.2	SPF		
ALL WEBS EXCEPT	2x4 DRY	No.2	SPF		
P - P	2x3 DRY	No.2	SPF		
P - F	2x3 DRY	No.2	SPF		

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-D 2	12	TOP
D-E 2	12	TOP
E-G 2	12	TOP
G-H 2	12	TOP
H-K 2	12	TOP
T-B 2	12	TOP
L-J 2	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
T-Q 2	12	TOP
Q-O 2	12	TOP
O-L 2	12	TOP
WEBS: (0.122"x3") SPIRAL NAILS		
2x3 1	6	SIDE(183.1)
M-I 2	2	SIDE(1269.7)
2x4 1	6	SIDE(1269.7)
S-C 2	2	SIDE(1269.7)

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
T	2540	0	2540	0
L	7741	0	7741	0

UNFACTORED REACTIONS	1ST CASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
T	1884	1241 / 0	0 / 0
L	5464	3643 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.85 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-P, F-P.
2x4 DRY SPF No.2 T-BRACE AT C-R
2x8 DRY SPF No.2 T-BRACE AT I-N

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0 / 33	-91.8 -91.8 0.04 (1)	C-R	-188 / 0
B-C	-3133 / 0	-91.8 -91.8 0.22 (1)	R-E	0 / 238
C-D	-3051 / 0	-91.8 -91.8 0.25 (1)	N-G	0 / 1853
D-E	-3051 / 0	-91.8 -91.8 0.25 (1)	N-I	-4718 / 0
E-F	-3089 / 0	-91.8 -91.8 0.13 (1)	P-G	-302 / 0
F-G	-3089 / 0	-91.8 -91.8 0.13 (1)	E-P	0 / 1075
G-H	-3802 / 0	-91.8 -91.8 0.31 (1)	P-F	-805 / 0
H-I	-3802 / 0	-91.8 -91.8 0.31 (1)	S-C	-596 / 0
I-J	-9121 / 0	-91.8 -91.8 0.26 (1)	B-S	0 / 2770
J-K	0 / 36	-91.8 -91.8 0.04 (1)	M-I	0 / 3891
T-B	-2810 / 0	0.0 0.0 0.09 (1)	M-J	0 / 7892
L-J	-7254 / 0	0.0 0.0 0.28 (1)		
T-S	0 / 0	-18.5 -18.5 0.04 (4)		
S-R	0 / 2882	-18.5 -18.5 0.22 (1)		
R-Q	0 / 2509	-18.5 -18.5 0.21 (1)		
Q-P	0 / 2509	-18.5 -18.5 0.21 (1)		
P-O	0 / 3253	-18.5 -18.5 0.27 (1)		
O-N	0 / 3253	-18.5 -18.5 0.27 (1)		
N-M	0 / 7639	-18.5 -18.5 0.57 (1)		
M-U	0 / 0	-18.5 -18.5 0.24 (1)		
U-L	0 / 0	-18.5 -18.5 0.24 (1)		

FACTORED CONCENTRATED LOADS (LBS)	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
JT	31-7-8	-5569	-5569	---	BACK	VERT	TOTAL	C1
U	33-8-4	-684	-684	---	BACK	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.16")

CSI: TC=0.31/1.00 (G-C1), BC=0.57/1.00 (M-N1), WB=0.70/1.00 (J-M1), SS=0.18/1.00 (L-M1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1897 788 1987 1898

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (R) (INPUT = 0.90)
JSI METAL = 0.85 (M) (INPUT = 1.00)



Structural component only
DWG# T-2008029 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T30	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:05:23 2020 Page 2
ID:DMCubINVR6TstF0e31v6l zns1L-XbiCbCqJ?DnhKzWChFKqhe9rzDi3Ac7gg2axCzLa9Q

PLATES (table is in inches)

JT.	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	6.0	9.0	3.00	4.25
C	TMVW-t	MT20	5.0	8.0		
D	TS-t	MT20	5.0	6.0		
E	TTWW+m	MT20	6.0	9.0	4.25	1.50
F	TMVW-w	MT20	3.0	6.0		
G	TTWW+m	MT20	6.0	9.0	4.25	1.50
H	TS-t	MT20	5.0	6.0		
I	TMVW-t	MT20	5.0	8.0		
J	TMVW-t	MT20	6.0	9.0	3.00	4.25
L	BMV1-t	MT20	8.0	9.0	Edge	0.50
M	BMVW-t	MT20	8.0	9.0		
N	BMVW-t	MT20	5.0	6.0	2.50	2.00
O	BS-t	MT20	5.0	6.0		
P	BMVW-t	MT20	5.0	8.0		
Q	BS-t	MT20	5.0	6.0		
R	BMVW-t	MT20	5.0	6.0	2.50	2.00
S	BMVW-t	MT20	9.0	9.0		
T	BMV1-t	MT20	6.0	9.0	5.50	

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2008029 7/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T31	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 2019 MITek Industries, Inc. Thu Apr 30 10:05:24 2020 Page 1

ID:DMCubINVR6TstFoe31v6l_zns11-?nGmpkrxmXvYx75FF6r3CvAHTNaKodmGvJn8UezLa9P

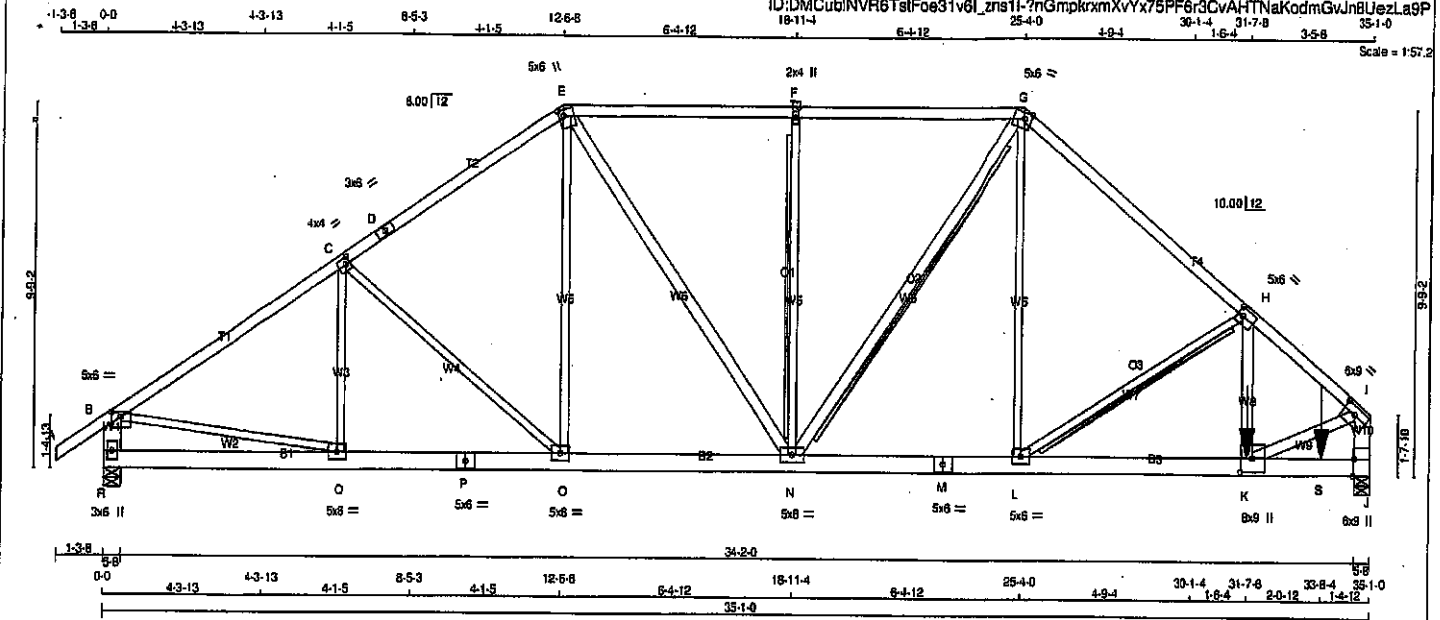

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
R - B	2x6	DRY	No.2
J - I	2x6	DRY	No.2
R - P	2x6	DRY	No.2
P - M	2x6	DRY	No.2
M - J	2x6	DRY	No.2

ALL WEBS 2x3 DRY No.2

EXCEPT
K - H 2x4 DRY No.2
K - I 2x4 DRY No.2
N - G 2x4 DRY No.2
E - N 2x4 DRY No.2

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - D 1	12	TOP
D - E 1	12	TOP
E - G 1	12	TOP
G - I 1	12	TOP
R - B 2	12	TOP
J - I 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
R - P 2	12	TOP
P - M 2	12	TOP
M - J 2	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	SIDE(183.1)
H - K 2	6	SIDE(1410.3)
2x4 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT 2689	0	0	5-8
R	HORIZ 8097	0	0	5-8

UNFACTORED REACTIONS	1ST CASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
R	1899	1264 / 0 0 / 0 0 / 0 0 / 0 0 / 0 0
J	5718	3798 / 0 0 / 0 0 / 0 0 / 0 0 / 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.04 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x6 DRY SPF No.2 T-BRACE AT H-L, G-N
2x4 DRY SPF No.2 T-BRACE AT F-N

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)
MEMB.					MEMB.		
FR-TO					FR-TO		
A-B	0 / 35	-91.8	-91.8	0.07 (1)	10.00	Q-C	-321 / 0
B-C	-3291 / 0	-91.8	-91.8	0.49 (1)	4.88	C-D	-345 / 0
C-D	-3058 / 0	-91.8	-91.8	0.45 (1)	4.82	D-E	0 / 356
D-E	-3058 / 0	-91.8	-91.8	0.45 (1)	4.82	E-G	0 / 2223
E-F	-3118 / 0	-91.8	-91.8	0.44 (1)	4.78	G-H	-3808 / 0
F-G	-3118 / 0	-91.8	-91.8	0.44 (1)	4.78	H-I	0 / 2901
G-H	-4126 / 0	-91.8	-91.8	0.48 (1)	4.38	I-J	0 / 4142
H-I	-8211 / 0	-91.8	-91.8	0.51 (1)	3.04	J-K	0 / 5730
I-J	-2828 / 0	0.0	0.0	0.09 (1)	7.81	K-L	-85 / 0
J-K	-7603 / 0	0.0	0.0	0.28 (1)	5.44	L-M	0 / 1075
K-L	0 / 0	-18.5	-18.5	0.05 (4)	10.00	M-N	-711 / 0
L-M	0 / 2768	-18.5	-18.5	0.20 (1)	10.00	N-F	
M-N	0 / 2768	-18.5	-18.5	0.20 (1)	10.00		
N-O	0 / 2512	-18.5	-18.5	0.19 (1)	10.00		
O-P	0 / 3167	-18.5	-18.5	0.24 (1)	10.00		
P-Q	0 / 3167	-18.5	-18.5	0.24 (1)	10.00		
Q-R	0 / 6348	-18.5	-18.5	0.48 (1)	10.00		
R-S	0 / 0	-18.5	-18.5	0.25 (1)	10.00		
S-J	0 / 0	-18.5	-18.5	0.25 (1)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
K	31-7-8	-6108	-6108	---	FRONT	VERT	TOTAL	---	C1
S	33-8-4	-684	-684	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.51/1.00 (H-I:1), BC=0.48/1.00 (K-L:1),
WB=0.70/1.00 (H-L:1), SS=0.16/1.00 (J-K:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 798 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (E) (INPUT = 0.90)
JSI METAL = 0.72 (K) (INPUT = 1.00)



Structural component only
DWG#, T-2008030


CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T32	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 6.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:05:25 2020 Page 1

ID:DMCubINVR6TstFca31vgI_zns11-T_q803szXq1PZHgbqMik6jMpmwDX7wQ8zXh04zLa9C
29-11-3 29-4-14 29-1-8 35-4-8 1-3-8

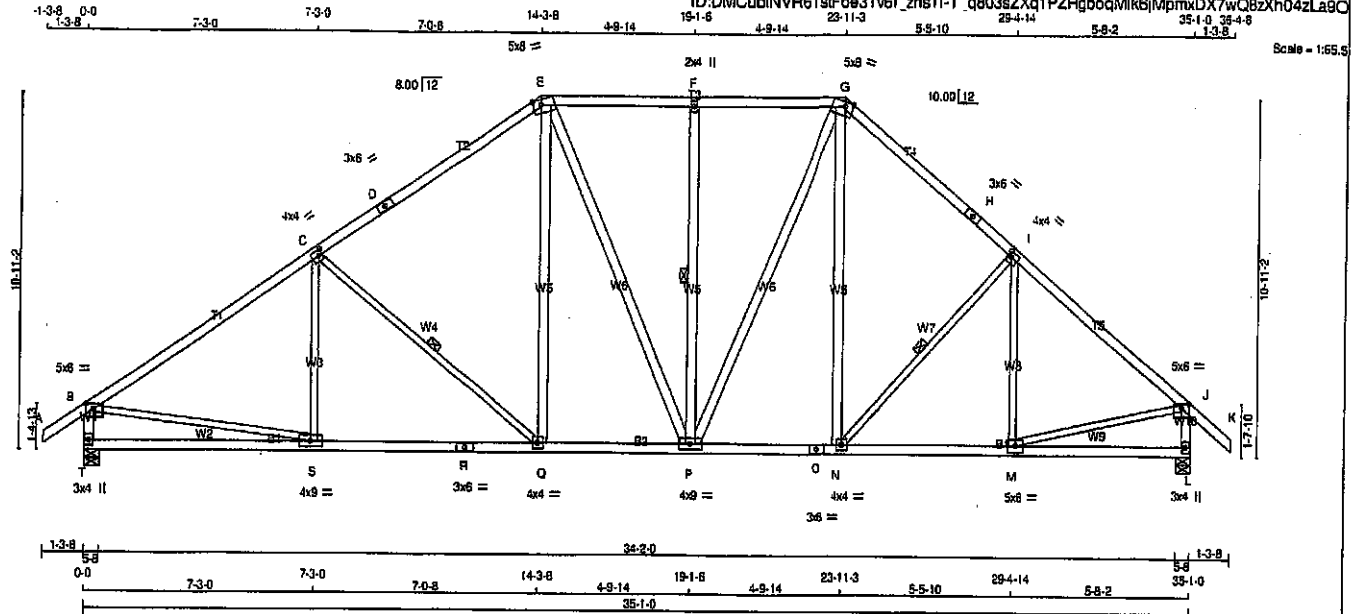

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
G - H	2x4	DRY	No.2	SPF
H - K	2x4	DRY	No.2	SPF
T - S	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
T - R	2x4	DRY	No.2	SPF
R - O	2x4	DRY	No.2	SPF
O - L	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x4	DRY	No.2	SPF
S - C	2x3	DRY	No.2	SPF
C - O	2x3	DRY	No.2	SPF
N - I	2x3	DRY	No.2	SPF
M - J	2x3	DRY	No.2	SPF
B - S	2x3	DRY	No.2	SPF
M - J	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE PLATES				
B TMVW-p	MT20	5.0	8.0	1.75 2.75
C TMVW-q	MT20	4.0	4.0	2.00 1.50
D TS-t	MT20	3.0	6.0	
E TTVW-m	MT20	5.0	8.0	2.00 3.00
F TMVW-w	MT20	2.0	4.0	
G TTVW-m	MT20	5.0	8.0	Edge 3.00
H TS-t	MT20	3.0	6.0	
I TMVW-t	MT20	4.0	4.0	2.00 1.25
J TMVW-p	MT20	5.0	8.0	1.50 3.00
L BMVW-t	MT20	3.0	4.0	
M BMVW-t	MT20	5.0	6.0	
N BMVW-t	MT20	4.0	4.0	
O BS-t	MT20	3.0	6.0	
P BMVW-t	MT20	4.0	4.0	
Q BMVW-t	MT20	4.0	4.0	
R BS-t	MT20	3.0	6.0	
S BMVW-t	MT20	4.0	4.0	
T BMVW-t	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	UPLIFT	IN-SX
T	2060	0	0	5-8
L	2061	0	0	5-8

UNFACTORED REACTIONS	MAX/MIN COMPONENT REACTIONS
JT	COMBINED
T	1454
L	1455

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.53 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-Q, F-P, I-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORZ. LOAD (LBS)
FR-TO						FR-TO			
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	S-C	-146 / 72	0.09 (1)	
B-C	-2352 / 0	-91.8	-91.8	0.85 (1)	3.53	C-Q	-585 / 0	0.35 (1)	
C-D	-1899 / 0	-91.8	-91.8	0.75 (1)	3.98	Q-E	0 / 484	0.08 (1)	
D-E	-1899 / 0	-91.8	-91.8	0.75 (1)	3.98	E-P	0 / 145	0.02 (1)	
E-F	-1608 / 0	-91.8	-91.8	0.30 (1)	4.80	P-F	-538 / 0	0.33 (1)	
F-G	-1608 / 0	-91.8	-91.8	0.30 (1)	4.80	P-G	0 / 526	0.08 (1)	
G-H	-1848 / 0	-91.8	-91.8	0.45 (1)	4.48	N-G	0 / 318	0.05 (1)	
H-I	-1848 / 0	-91.8	-91.8	0.45 (1)	4.48	N-I	-302 / 0	0.14 (1)	
I-J	-2032 / 0	-91.8	-91.8	0.48 (1)	4.28	M-I	-250 / 9	0.18 (1)	
J-K	0 / 41	-91.8	-91.8	0.13 (1)	10.00	B-S	0 / 2015	0.48 (1)	
T-B	-2005 / 0	0.0	0.0	0.21 (1)	5.98	M-J	0 / 1633	0.37 (1)	
L-J	-2017 / 0	0.0	0.0	0.21 (1)	5.94				
T-S	0 / 0	-18.5	-18.5	0.24 (4)	10.00				
S-R	0 / 1983	-18.5	-18.5	0.44 (1)	10.00				
R-O	0 / 1983	-18.5	-18.5	0.44 (1)	10.00				
Q-P	0 / 1548	-18.5	-18.5	0.32 (1)	10.00				
P-O	0 / 1380	-18.5	-18.5	0.28 (1)	10.00				
O-N	0 / 1380	-18.5	-18.5	0.28 (1)	10.00				
N-M	0 / 1581	-18.5	-18.5	0.32 (1)	10.00				
M-L	0 / 0	-18.5	-18.5	0.14 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF SBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/989 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/989 (0.18")

CSI: TC=0.85/1.00 (B-C:1), BC=0.44/1.00 (Q-S:1), WB=0.48/1.00 (B-S:1), SS=0.27/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.89 (J) (INPUT = 0.90)
JSI METAL= 0.67 (R) (INPUT = 1.00)




Structural component only
DWG# T-2008031

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T33	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:05:25 2020 Page 1

ID:DMCubINVR6TstFoe31v6L_zns1-T_q803sZXq1PZHgbqMlk6jQPmX7qQ8zXh04zLa9C

Scale = 1:50.6

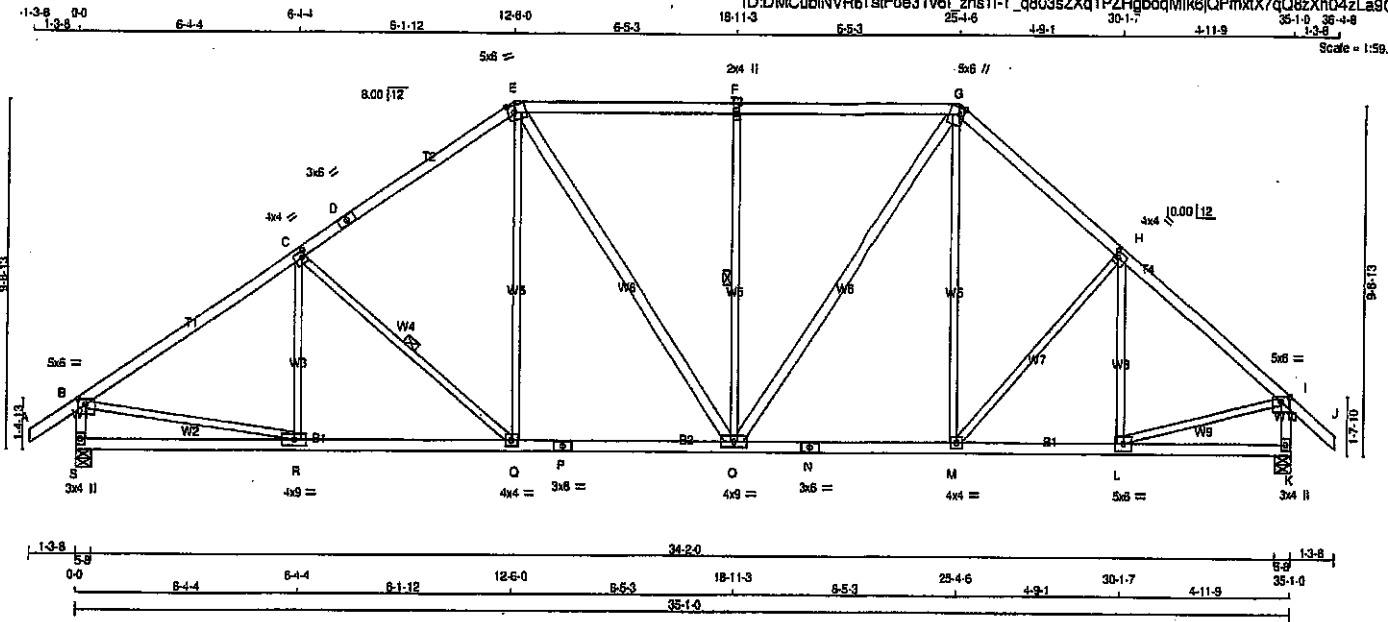

TOTAL WEIGHT = 170 lb (M/F)

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - J	2x4	DRY	No.2
S - B	2x4	DRY	No.2
K - I	2x4	DRY	No.2
S - P	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
E - O	2x4	DRY	No.2
O - G	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW-p	MT20	5.0	6.0 1.75 2.75
C	TMVW-t	MT20	4.0	4.0 2.00 1.50
D	TS-t	MT20	3.0	6.0
E	TTWW-m	MT20	5.0	6.0 2.25 2.00
F	TMW-w	MT20	2.0	4.0
G	TTWW-m	MT20	5.0	6.0 2.25 1.50
H	TMVW-t	MT20	4.0	4.0 2.00 1.25
I	TMVW-p	MT20	5.0	6.0 1.50 3.00
K	BMV1-p	MT20	3.0	4.0
L	BMVW-t	MT20	5.0	6.0
M	BMVW-t	MT20	4.0	4.0
N	BS-t	MT20	3.0	6.0
O	BMVW-wt	MT20	4.0	9.0
P	BS-t	MT20	3.0	6.0
Q	BMVW-t	MT20	4.0	4.0
R	BMVW-t	MT20	4.0	9.0
S	BMV1-p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
S	2060	0	2060	0	5-8
K	2061	0	2061	0	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN	COMPONENT REACTIONS	1ST LCASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
S	1454	968 / 0	0 / 0	0 / 0	0 / 0
K	1455	968 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.88 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-Q, F-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0 / 35	R-C	-211 / 32
B-C	-2349 / 0	C-Q	-437 / 0
C-D	-2028 / 0	Q-E	0 / 398
D-E	-2028 / 0	E-O	0 / 325
E-F	-1840 / 0	O-F	-723 / 0
F-G	-1840 / 0	G-G	0 / 696
G-H	-1921 / 0	H-G	0 / 243
H-I	-2008 / 0	I-H	-184 / 0
I-J	0 / 41	J-I	-319 / 0
J-K	-2011 / 0	K-I	0 / 2014
K-L	-2021 / 0	L-I	0 / 1621
S-R	0 / 0		
R-Q	0 / 1986		
Q-P	0 / 1857		
P-O	0 / 1857		
O-N	0 / 1448		
N-M	0 / 1448		
M-L	0 / 1568		
L-K	0 / 0		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.17")

CSI: TC=0.62/1.00 (B-C:1), BC=0.40/1.00 (Q-R:1), WB=0.46/1.00 (F-O:1), SS=0.29/1.00 (E-F:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSD) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1657 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (I) (INPUT = 0.90)
JSI METAL = 0.48 (P) (INPUT = 1.00)




Structural component only
DWG# T-2008032

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408316	T34	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 11:34:36 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1H-Qf24mc3MwC91cE0m7s76XrxdD8m81b_EKJfRzLYrn

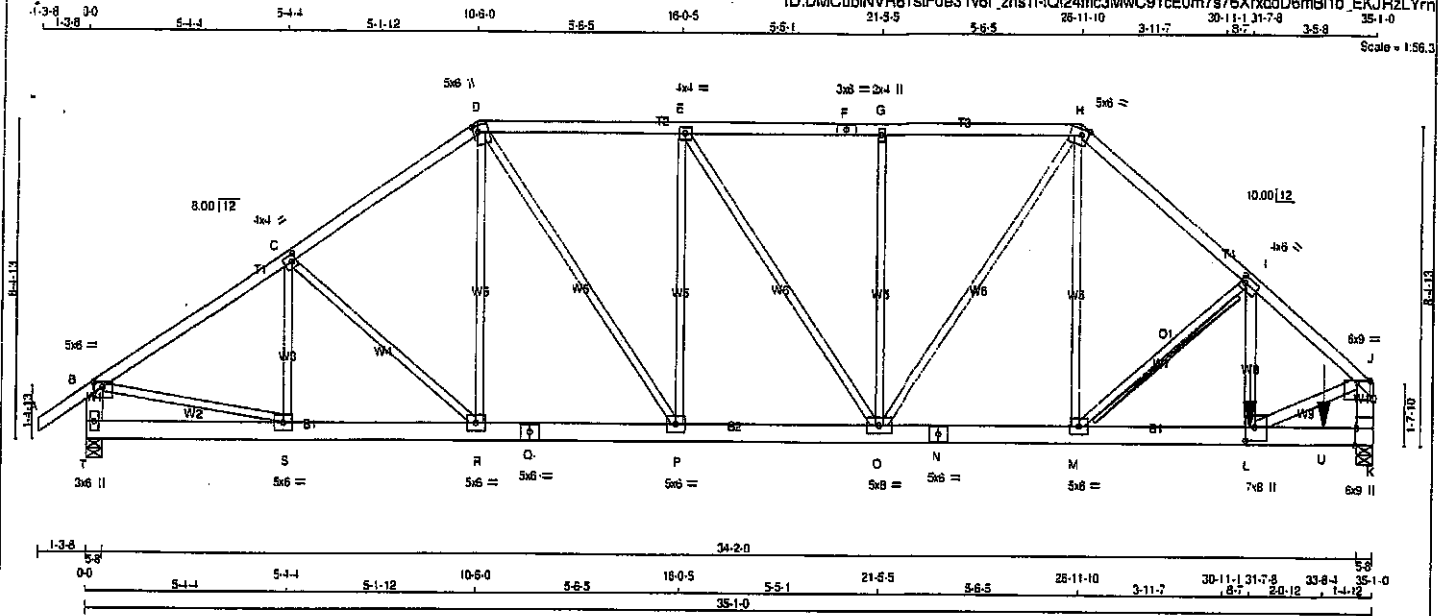

TOTAL WEIGHT = 2 X 187 = 374 lb

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - H	2x4	DRY No.2	SPF
H - J	2x4	DRY No.2	SPF
T - B	2x6	DRY No.2	SPF
K - J	2x6	DRY No.2	SPF
T - Q	2x6	DRY No.2	SPF
Q - N	2x6	DRY No.2	SPF
N - K	2x6	DRY No.2	SPF
ALL WEBS EXCEPT L - I, L - J	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - D	12	TOP
D - F	12	TOP
F - H	12	TOP
H - J	12	TOP
T - B	12	TOP
K - J	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
T - Q	12	TOP
Q - N	12	TOP
N - K	12	SIDE (183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	SIDE (1194.0)
1 - L	3	
2x4	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT VERT	2603	0	5-8
T	2603	0	5-8
K	7230	0	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT COMBINED	1837	1223	0	0	0	614	0
T	5106	3392	0	0	0	1714	0
K							

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.42 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT I-M

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO		FROM TO	CSH (LBS)	FR-TO			
A-B	0 35	-91.8	-91.8 0.07 (1)	10.00	S-C	-416 0	0.07 (1)
B-C	-3111 0	-91.8	-91.8 0.30 (1)	4.96	C-R	-160 0	0.07 (1)
C-D	-3032 0	-91.8	-91.8 0.30 (1)	5.01	R-D	0 231	0.03 (1)
D-E	-3217 0	-91.8	-91.8 0.27 (1)	4.92	D-P	0 1270	0.16 (1)
E-F	-3492 0	-91.8	-91.8 0.28 (1)	4.75	P-E	-951 0	0.64 (1)
F-G	-3492 0	-91.8	-91.8 0.28 (1)	4.75	E-O	0 492	0.06 (1)
G-H	-3492 0	-91.8	-91.8 0.27 (1)	4.76	O-G	-534 0	0.36 (1)
H-I	-4347 0	-91.8	-91.8 0.26 (1)	4.40	O-H	0 259	0.03 (1)
I-J	-7316 0	-91.8	-91.8 0.33 (1)	3.42	M-H	0 2163	0.27 (1)
T-B	-2546 0	0.0	0.0 0.09 (1)	7.81	M-I	-3065 0	0.58 (1)
K-J	-6805 0	0.0	0.0 0.25 (1)	5.71	L-I	0 3477	0.31 (1)
					B-S	0 2859	0.33 (1)
					L-J	0 5980	0.53 (1)
T-S	0	-18.5	-18.5 0.03 (4)	10.00			
S-R	0 2614	-18.5	-18.5 0.19 (1)	10.00			
R-Q	0 2496	-18.5	-18.5 0.19 (1)	10.00			
Q-P	0 2496	-18.5	-18.5 0.19 (1)	10.00			
P-O	0 3217	-18.5	-18.5 0.23 (1)	10.00			
O-N	0 3345	-18.5	-18.5 0.24 (1)	10.00			
N-M	0 3345	-18.5	-18.5 0.24 (1)	10.00			
M-L	0 5840	-18.5	-18.5 0.44 (1)	10.00			
L-U	0 0	-18.5	-18.5 0.21 (1)	10.00			
U-K	0 0	-18.5	-18.5 0.21 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
L	31-7-8	-5279	-5279	---	BACK	VERT	TOTAL	---	C1
U	33-8-4	-560	-560	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL DL = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/999 (0.07")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/999 (0.13")

CSI: TC=0.33/1.00 (I-J), BC=0.44/1.00 (L-M), WB=0.64/1.00 (E-P), SS=0.14/1.00 (K-L)

DDL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVEHEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (L) INPUT = 0.90 ; JSI METAL= 0.73 (L) INPUT = 1.00 ;



Structural component only
DWG# T-2008033 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T34	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Thu Apr 30 11:34:36 2020 Page 2
ID:DMCubINVR6T9tFoe31v6I_zns1H-QI24mc3MwC91cE0m7s76XrxdoD6m811b_EKJRzLYm

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	5.0	1.50	3.00
C	TMWW-t	MT20	4.0	4.0	2.00	1.50
D	TTWW-m	MT20	5.0	6.0	2.00	1.50
E	TMWW-t	MT20	4.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMW-w	MT20	2.0	4.0		
H	TTWW-m	MT20	5.0	6.0	2.00	2.25
I	TMWW-t	MT20	4.0	6.0	2.00	1.50
J	TMVW-p	MT20	6.0	9.0	Edge	
K	BMV1-t	MT20	6.0	9.0	Edge	0.50
L	BMWW-t	MT20	7.0	8.0	4.25	3.00
M, P, R, S						
M	BMWW-t	MT20	5.0	6.0		
N	BS-t	MT20	5.0	6.0		
O	BMWW-t	MT20	5.0	6.0		
Q	BS-t	MT20	5.0	6.0		
T	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.



Structural component only
DWG# T-2008033 3/2

JOB NAME 408316	TRUSS NAME T35	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------


Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:05:28 2020 Page 1

ID:DMCubINVR6tstFoe31v6l_zns1-uZWHe5uRpIPzQkOAUyw?MLzQ_3kRFsqxLDpZLa9L

15-11-4 17-2-8 18-11-4 23-6-2 29-11-0 31-7-8 33-11-8 34-5-0 35-9-8

Scale = 1:56.5

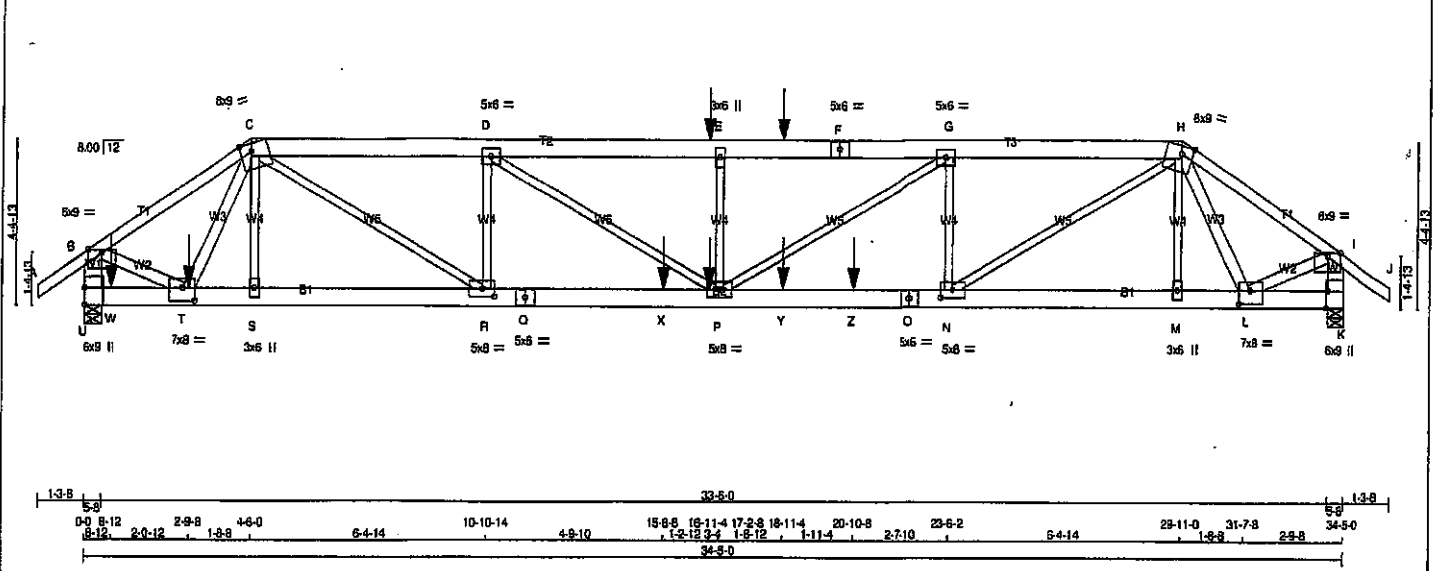

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. SPF A - C 2x4 DRY No.2 SPF C - F 2x6 DRY No.2 SPF F - H 2x6 DRY No.2 SPF H - J 2x4 DRY No.2 SPF U - B 2x6 DRY No.2 SPF K - I 2x6 DRY No.2 SPF U - Q 2x6 DRY No.2 SPF Q - O 2x6 DRY No.2 SPF O - K 2x6 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT L - I 2x4 DRY No.2 SPF B - T 2x4 DRY No.2 SPF J - C 2x4 DRY No.2 SPF H - L 2x4 DRY No.2 SPF DRY: SEASONED LUMBER. DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS: CHORDS #ROWS SURFACE SPACING (IN) LOAD(PLF) TOP CHORDS : (0.122"x3") SPIRAL NAILS A-C 1 12 TOP H-J 1 12 TOP C-F 2 12 TOP F-H 2 12 TOP U-B 2 12 TOP K-I 2 12 TOP BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS Q-O 2 12 SIDE(0.0) U-Q 2 12 SIDE(183.1) O-K 2 12 TOP WEBS : (0.122"x3") SPIRAL NAILS 2x3 1 6 2x4 1 6 NAILS TO BE DRIVEN FROM ONE SIDE ONLY. GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED GROSS REACTION MAXIMUM FACTORED GROSS REACTION INPUT REORD JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX U 7874 0 7874 0 0 5-8 5-8 K 3710 0 3710 0 0 5-8 5-8 UNFACTORED REACTIONS 1ST CASE MAX/MIN COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL U 5584 3726/0 0/0 0/0 0/0 1828/0 0/0 K 2615 1766/0 0/0 0/0 0/0 849/0 0/0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, K BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.14 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS MAX. FACTORED FORCE (LBS) FACTORED VERT. LOAD LC1 MAX. FACTORED FORCE (LBS) WEBS MAX. FACTORED FORCE (LBS) MAX. FACTORED FORCE (LBS) FR-TO MEMB. FROM TO CSI (LC) UNBRACED LENGTH FR-TO MEMB. FORCE MAX. CSI (LC) A-B 0/35 -91.8 -91.8 0.07 (1) 10.00 S-C 0/428 0.05 (1) B-C -8031/0 -91.8 -91.8 0.51 (1) 3.14 M-H 0/134 0.02 (4) C-D -9185/0 -91.8 -91.8 0.30 (1) 3.85 L-I 0/3411 0.30 (1) D-E -10772/0 -91.8 -91.8 0.32 (1) 3.56 B-T 0/7148 0.83 (1) E-V -10772/0 -91.8 -91.8 0.36 (1) 3.53 T-C 0/1794 0.16 (1) V-F -10772/0 -91.8 -91.8 0.36 (1) 3.53 H-L -1428/0 0.17 (1) F-G -10772/0 -91.8 -91.8 0.36 (1) 3.53 N-H 0/5428 0.87 (1) G-H -8408/0 -91.8 -91.8 0.27 (1) 4.02 C-R 0/3749 0.46 (1) H-I -3832/0 -91.8 -91.8 0.26 (1) 4.60 N-G -2204/0 0.29 (1) I-J 0/35 -91.8 -91.8 0.07 (1) 10.00 R-D -1890/0 0.22 (1) U-B -7249/0 0.0 0.0 0.28 (1) 5.56 P-G 0/2789 0.35 (1) K-I -3833/0 0.0 0.0 0.13 (1) 7.37 D-P 0/1896 0.23 (1) P-E -727/0 0.10 (1) U-W 0/0 -18.5 -18.5 0.19 (1) 10.00 W-T 0/0 -18.5 -18.5 0.19 (1) 10.00 T-S 0/5967 -18.5 -18.5 0.58 (1) 10.00 S-R 0/5978 -18.5 -18.5 0.45 (1) 10.00 R-Q 0/9165 -18.5 -18.5 0.93 (1) 10.00 Q-X 0/9165 -18.5 -18.5 0.93 (1) 10.00 X-P 0/9165 -18.5 -18.5 0.93 (1) 10.00 P-Y 0/8408 -18.5 -18.5 0.94 (1) 10.00 Y-Z 0/8408 -18.5 -18.5 0.94 (1) 10.00 Z-O 0/8408 -18.5 -18.5 0.94 (1) 10.00 O-N 0/8408 -18.5 -18.5 0.94 (1) 10.00 N-M 0/3795 -18.5 -18.5 0.36 (1) 10.00 M-L 0/3792 -18.5 -18.5 0.30 (1) 10.00 L-K 0/0 -18.5 -18.5 0.05 (1) 10.00 FACTORED CONCENTRATED LOADS (LBS) JT LOC. LC1 MAX. MAX+ FACE DIR. TYPE HEEL CONN. E 16-11-4 -115 -115 --- FRONT VERT TOTAL --- C1 P 16-11-4 -23 -23 --- FRONT VERT TOTAL --- C1 T 2-9-8 -4435 -4435 --- BACK VERT TOTAL --- C1 V 18-11-4 -115 -115 --- FRONT VERT TOTAL --- C1 W 8-12 -583 -583 --- BACK VERT TOTAL --- C1 X 15-8-8 -1259 -1259 --- FRONT VERT TOTAL --- C1 Y 18-11-4 -23 -23 --- FRONT VERT TOTAL --- C1 Z 20-10-3 -1008 -1008 --- FRONT VERT TOTAL --- C1 CONNECTION REQUIREMENTS 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 25.6 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF CBC 2018, CBC 2012, ABC 2019 - PART 9 OF CBC 2012 (2019 AMENDMENT) - CSA 088-08, CSA 088-14 - TPIC 2011, TPIC 2014 (55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL) = L/360 (1.15") CALCULATED VERT. DEFL.(LL) = L/999 (0.28") ALLOWABLE DEFL.(TL) = L/360 (1.15") CALCULATED VERT. DEFL.(TL) = L/881 (0.47") CSI: C=0.51/1.00 (B-C:1), BC=0.94/1.00 (N-P:1), WB=0.67/1.00 (H-N:1), SS=0.38/1.00 (P-R:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00 COMPANION LIVE LOAD FACTOR = 1.00 AUTOSOLVE HEELS OFF TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 816 354 1657 788 1987 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP = 0.90 (N) (INPUT = 0.90) JSI METAL = 0.84 (Q) (INPUT = 1.00)			
--	--	--	--	---	--	--	--	---	--	--	--



Structural component only
DWG# T-2008034 1/2

JOB NAME 408316	TRUSS NAME T35	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	ORWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:05:28 2020 Page 2
 ID:DMCubINVR6TsiFog31v6I zns11-uZWHe5uRpIPzOkOAUvw?MILzQ r3kRFsqxILdPzLa9L

PLATES (table is in inches)

JT - TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	6.0	9.0	Edge	
C TTWW-m	MT20	8.0	9.0	2.50	3.50
D TMW-t	MT20	6.0	6.0		
E TMW-w	MT20	3.0	6.0		
F TS-t	MT20	5.0	6.0		
G TMW-t	MT20	5.0	6.0		
H TTWW-m	MT20	8.0	9.0	2.50	3.50
I TMVW-p	MT20	6.0	9.0	Edge	
K BMV1-t	MT20	6.0	9.0	Edge	0.50
L BMW-t	MT20	7.0	8.0	4.25	3.75
M BMW-w	MT20	3.0	6.0		
N BMW-t	MT20	5.0	8.0	2.50	3.75
O BS-t	MT20	5.0	6.0		
P BMWW-t	MT20	5.0	8.0		
Q BS-t	MT20	5.0	6.0		
R BMW-t	MT20	5.0	8.0	2.50	3.75
S BMW-w	MT20	3.0	6.0		
T BMW-t	MT20	7.0	8.0	4.25	3.75
U BMV1-t	MT20	6.0	9.0	5.50	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS


- 1) Ct: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
 DWG# T-2008034 42

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T36	6	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 10:05:28 2020 Page 1
 ID:DMCubINVR6TstFoe31v6l_zns1f-uZWHe5uRPlPzQK0AUyw?MLVh_zkTWsqxldPzLa9L
 17-8-8 21-2-8 25-0-8 31-6-0

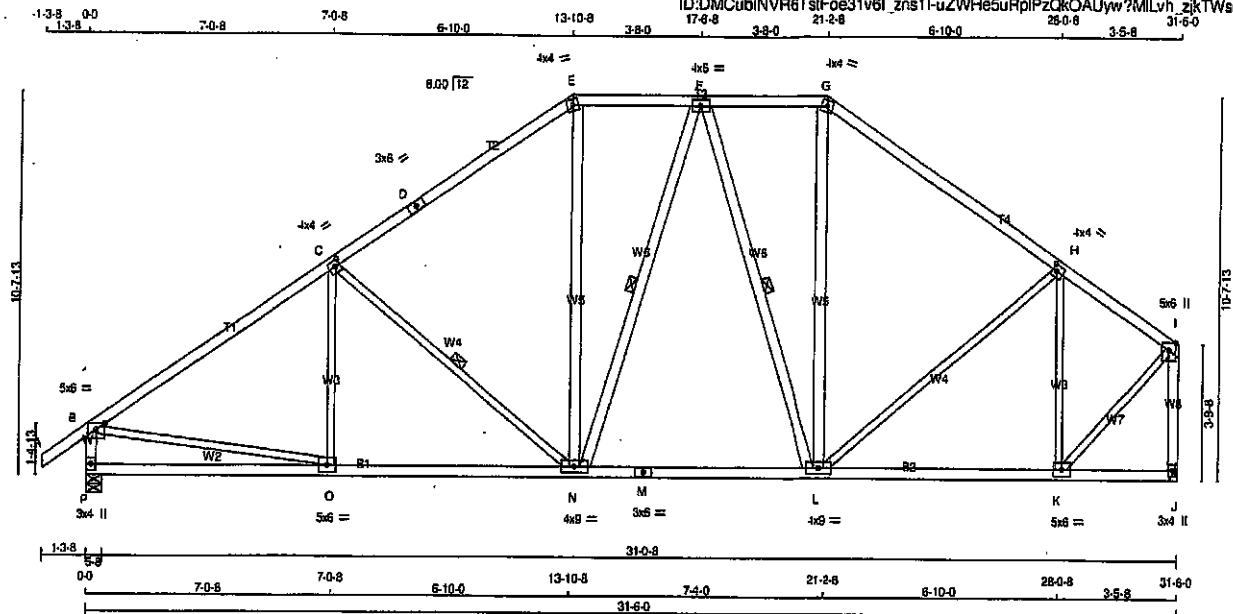

Scale = 1/8" = 1'-0"

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - J	2x4	DRY	No.2
J - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
N - E	2x4	DRY	No.2
N - F	2x4	DRY	No.2
F - L	2x4	DRY	No.2
L - G	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	6.0	Edge	
C TMVW-t	MT20	4.0	4.0	2.00	1.50
D TS-t	MT20	3.0	6.0		
E TTW-m	MT20	4.0	4.0		
F TMVW-t	MT20	4.0	8.0		
G TTW-m	MT20	4.0	4.0		
H TMVW-t	MT20	4.0	4.0	2.00	1.50
I TMVW-p	MT20	5.0	6.0	Edge	
J BMV-t	MT20	3.0	4.0		
K BMVW-t	MT20	5.0	6.0		
L BMVW-t	MT20	4.0	9.0		
M SS-t	MT20	3.0	6.0		
N BMVW-t	MT20	4.0	9.0		
O BMVW-t	MT20	5.0	6.0		
P BMV-t	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
P	1862	0	1862	0	5-8
J	1738	0	1738	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3'-8".

UNFACTORED REACTIONS							
1ST LOASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
P	1315	878 / 0	0 / 0	0 / 0	0 / 0	439 / 0	0 / 0
J	1228	808 / 0	0 / 0	0 / 0	0 / 0	422 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.87 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-N, F-N, P-L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
 TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	O-C	-126 / 72	0.07 (1)
B-C	-2083 / 0	-91.8	-91.8 0.75 (1)	3.87	C-N	-581 / 0	0.33 (1)
C-D	-1812 / 0	-91.8	-91.8 0.67 (1)	4.36	N-E	0 / 503	0.08 (1)
D-E	-1612 / 0	-91.8	-91.8 0.67 (1)	4.36	N-F	-5 / 32	0.01 (4)
E-F	-1311 / 0	-91.8	-91.8 0.17 (1)	5.48	F-L	-420 / 0	0.27 (1)
F-G	-1177 / 0	-91.8	-91.8 0.16 (1)	5.71	L-G	0 / 393	0.06 (1)
G-H	-1442 / 0	-91.8	-91.8 0.58 (1)	4.73	L-H	0 / 220	0.05 (1)
H-I	-1142 / 0	-91.8	-91.8 0.43 (1)	5.38	K-H	-898 / 0	0.53 (1)
I-J	-1808 / 0	0.0	0.0 0.19 (1)	8.22	B-O	0 / 1772	0.40 (1)
J-I	-1719 / 0	0.0	0.0 0.41 (1)	6.35	K-I	0 / 1420	0.32 (1)
P-O	0 / 0	-18.5	-18.5 0.21 (4)	10.00			
O-N	0 / 1752	-18.5	-18.5 0.39 (1)	10.00			
N-M	0 / 1313	-18.5	-18.5 0.32 (1)	10.00			
M-L	0 / 1313	-18.5	-18.5 0.32 (1)	10.00			
L-K	0 / 1002	-18.5	-18.5 0.27 (4)	10.00			
K-J	0 / 0	-18.5	-18.5 0.13 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF NBCC 2010, NBC 2012, ABC 2019
 - PART 9 OF NBC 2012 (2019 AMENDMENT)
 - CSA 888-09, CSA 888-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.05")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
 ALLOWABLE DEFL.(TL) = L/360 (1.05")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.75/1.00 (B-C:1), BC=0.39/1.00 (N-O:1), WB=0.53/1.00 (H-K:1), SS=0.26/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (B) (INPUT = 0.90)
 JSI METAL = 0.45 (B) (INPUT = 1.00)




Structural component only
 DWG# T-2008035

JOB NAME 408316	TRUSS NAME T37	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:05:28 2020 Page 1

ID:DMCubINVR8TstFoe31vdl_zns11-MI4tsRv3a3Xq2uzM1fREvyyu0hOHDtIP?26Vv9szLa9K

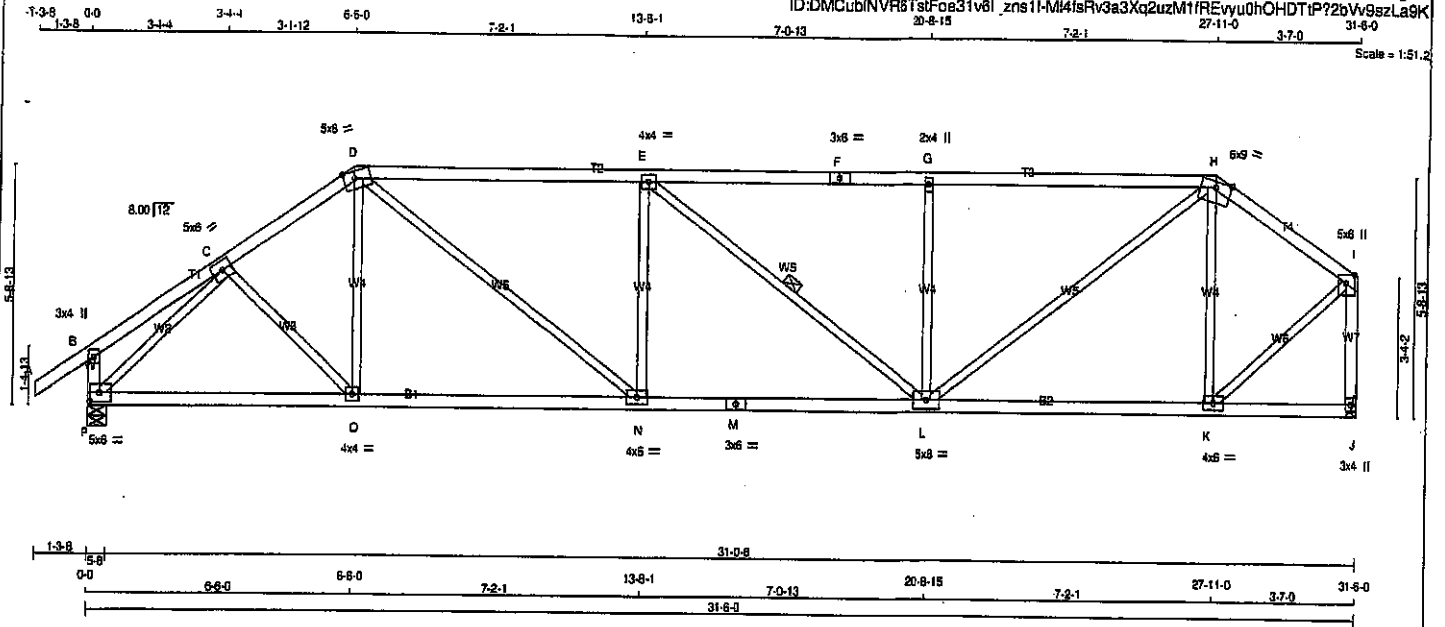

TOTAL WEIGHT = 129 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
P - B	2x4	DRY	No.2
J - I	2x4	DRY	No.2
P - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMVW-t	MT20	5.0	6.0		
D TTWW-m	MT20	5.0	8.0	2.00	3.25
E TMVW-t	MT20	4.0	4.0		
F TS-t	MT20	3.0	6.0		
G TMV+w	MT20	2.0	4.0		
H TTWW-m	MT20	6.0	9.0	Edge	
I TMVW+p	MT20	5.0	6.0	Edge	
J BMV+p	MT20	3.0	4.0		
K BMVW-t	MT20	4.0	6.0		
L BMVWV-t	MT20	5.0	8.0		
M BS-t	MT20	3.0	6.0		
N BMVW-t	MT20	4.0	6.0		
O BMVW-t	MT20	4.0	4.0		
P BMVW-t	MT20	5.0	6.0	2.50	2.75

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
P	1862	0	1862	0	5-8
J	1736	0	1736	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3-8.

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
P	1315	876 / 0	0 / 0	0 / 0	0 / 0	439 / 0	0 / 0
J	1228	806 / 0	0 / 0	0 / 0	0 / 0	422 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	C-O	0 / 136	0.03 (4)
B-C	0 / 16	-91.8	-91.8 0.13 (1)	10.00	O-D	0 / 97	0.03 (4)
C-D	-2023 / 0	-91.8	-91.8 0.18 (1)	4.80	D-N	0 / 1124	0.25 (1)
D-E	-2564 / 0	-91.8	-91.8 0.99 (1)	3.25	N-E	-551 / 0	0.28 (1)
E-F	-2355 / 0	-91.8	-91.8 0.93 (1)	3.41	E-L	-263 / 0	0.14 (1)
F-G	-2355 / 0	-91.8	-91.8 0.93 (1)	3.41	L-G	-711 / 0	0.35 (1)
G-H	-2355 / 0	-91.8	-91.8 0.93 (1)	3.42	L-H	0 / 1662	0.37 (1)
H-I	-1257 / 0	-91.8	-91.8 0.23 (1)	5.47	K-H	-739 / 0	0.37 (1)
P-S	-246 / 0	0.0	0.0 0.03 (1)	7.81	P-C	-2218 / 0	0.74 (1)
J-I	-1720 / 0	0.0	0.0 0.33 (1)	6.35	K-I	0 / 1350	0.30 (1)
P-Q	0 / 1588	-18.5	-18.5 0.37 (1)	10.00			
O-N	0 / 1667	-18.5	-18.5 0.38 (1)	10.00			
N-M	0 / 2584	-18.5	-18.5 0.50 (1)	10.00			
M-L	0 / 2584	-18.5	-18.5 0.50 (1)	10.00			
L-K	0 / 1029	-18.5	-18.5 0.27 (4)	10.00			
K-J	0 / 0	-18.5	-18.5 0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.05")
CALCULATED VERT. DEFL. (LL) = L/999 (0.12")
ALLOWABLE DEFL. (TL) = L/360 (1.05")
CALCULATED VERT. DEFL. (TL) = L/999 (0.25")

CSI: TC=0.99/1.00 (D-E:1), BC=0.50/1.00 (L-N:1),
WB=0.74/1.00 (C-P:1), SS=0.31/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 789 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (C) (INPUT = 0.90)
JSI METAL = 0.82 (M) (INPUT = 1.00)

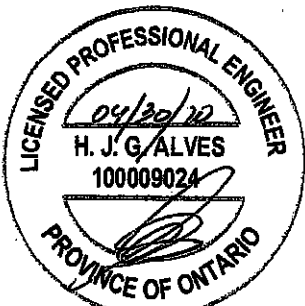

Structural component only
DWG# T-2008036

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T38	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

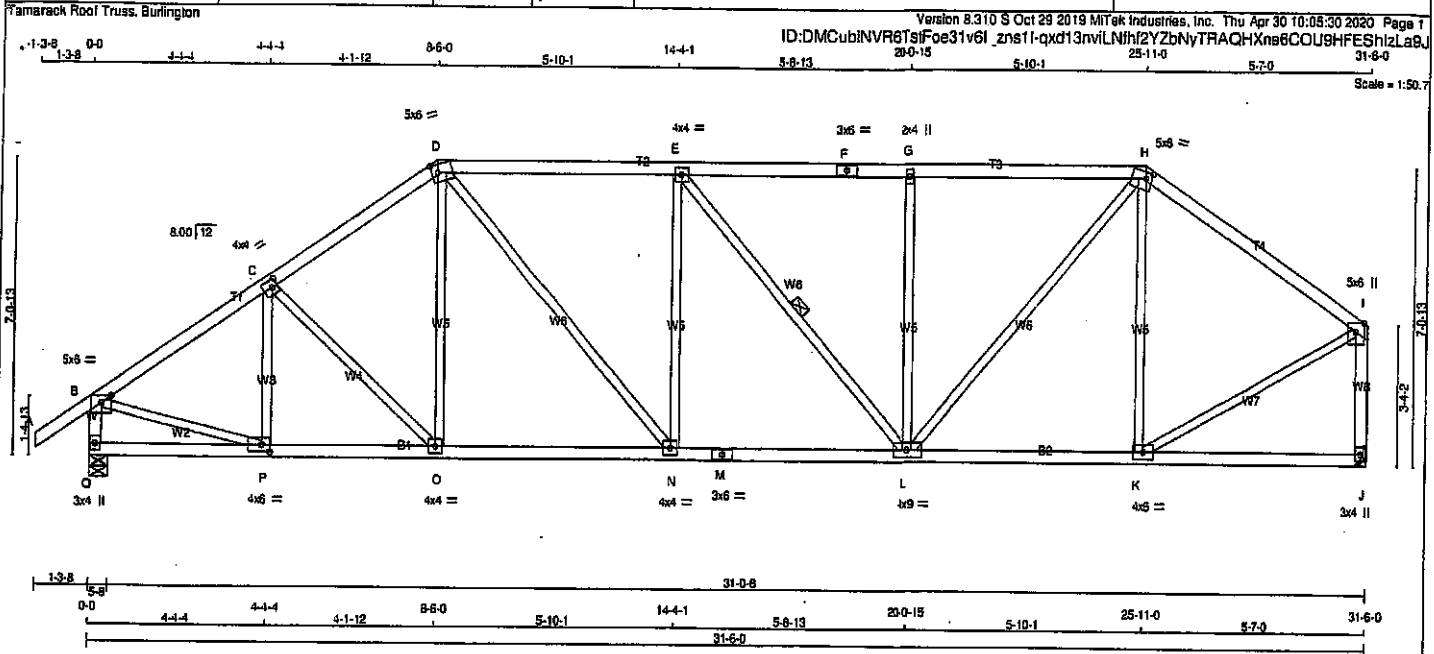

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
I - J	2x4	DRY	No.2
J - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMWW-p	MT20	5.0	6.0	Edge	
C TMWW-m	MT20	4.0	4.0	2.00	1.50
D TTWW-m	MT20	5.0	6.0	2.25	1.75
E TMWW-t	MT20	4.0	4.0		
F TS-t	MT20	3.0	8.0		
G TMWW-w	MT20	2.0	4.0		
H TMWW-m	MT20	5.0	8.0	1.75	1.75
I TMWW-p	MT20	5.0	6.0	Edge	
J BMV1-p	MT20	3.0	4.0		
K BMWW-t	MT20	4.0	6.0		
L BMWW-w	MT20	4.0	6.0		
M BS-t	MT20	3.0	6.0		
N BMWW-t	MT20	4.0	4.0		
O BMWW-t	MT20	4.0	4.0		
P BMWW-t	MT20	4.0	6.0	2.00	2.25
Q BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		RECORD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX
Q	1862	0	1862	0	0	5-8	5-8	
J	1736	0	1736	0	0	MECHANICAL		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J MINIMUM BEARING LENGTH AT JOINT J = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE		MAX/MIN COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
Q	1315	876 / 0	0 / 0	0 / 0	0 / 0	439 / 0	0 / 0
J	1228	806 / 0	0 / 0	0 / 0	0 / 0	422 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.14 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED (PLF)	MAX. FACTORED (PLF)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED (PLF)	MAX. FACTORED (PLF)
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	P-C	-342 / 0	0.09 (1)	0.09 (1)
B-C	-2003 / 0	-91.8	-91.8 0.35 (1)	C-D	-122 / 0	0.07 (1)	0.07 (1)
C-D	-1949 / 0	-91.8	-91.8 0.34 (1)	D-E	0 / 181	0.04 (4)	0.04 (4)
D-E	-2053 / 0	-91.8	-91.8 0.54 (1)	E-F	0 / 692	0.16 (1)	0.16 (1)
E-F	-1915 / 0	-91.8	-91.8 0.53 (1)	F-G	-414 / 0	0.36 (1)	0.36 (1)
F-G	-1915 / 0	-91.8	-91.8 0.53 (1)	G-H	-576 / 0	0.50 (1)	0.50 (1)
G-H	-1914 / 0	-91.8	-91.8 0.52 (1)	H-I	0 / 1108	0.25 (1)	0.25 (1)
H-I	-1442 / 0	-91.8	-91.8 0.50 (1)	I-J	-515 / 0	0.44 (1)	0.44 (1)
I-J	-1825 / 0	0.0	0.0 0.19 (1)	J-K	0 / 1736	0.39 (1)	0.39 (1)
J-K	-1695 / 0	0.0	0.0 0.32 (1)	K-L	0 / 1357	0.31 (1)	0.31 (1)
Q-P	0 / 0	-18.5	-18.5 0.07 (4)				
P-O	0 / 1687	-18.5	-18.5 0.33 (1)				
O-N	0 / 1601	-18.5	-18.5 0.32 (1)				
N-M	0 / 2053	-18.5	-18.5 0.40 (1)				
M-L	0 / 2053	-18.5	-18.5 0.40 (1)				
L-K	0 / 1190	-18.5	-18.5 0.28 (1)				
K-J	0 / 0	-18.5	-18.5 0.15 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.05")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL) = L/360 (1.05")
CALCULATED VERT. DEFL.(TL) = L/999 (0.17")

CSI: TC=0.80/1.00 (H-I), BC=0.40/1.00 (L-N-1), WB=0.50/1.00 (G-L-1), SS=0.25/1.00 (D-E-1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (B) (INPUT = 0.90)
JSI METAL= 0.59 (M) (INPUT = 1.00)




Structural component only
DWG# T-2008037

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408316	T39	1	1	TRUSS DESC.		

Palmarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:05:31 2020 Page 1

ID:DMCubINVR6TsiFoe31v61_zns11-185PH7wK6gnYHC7184TI_NzSNG?yxqfWv_?DkzLab1

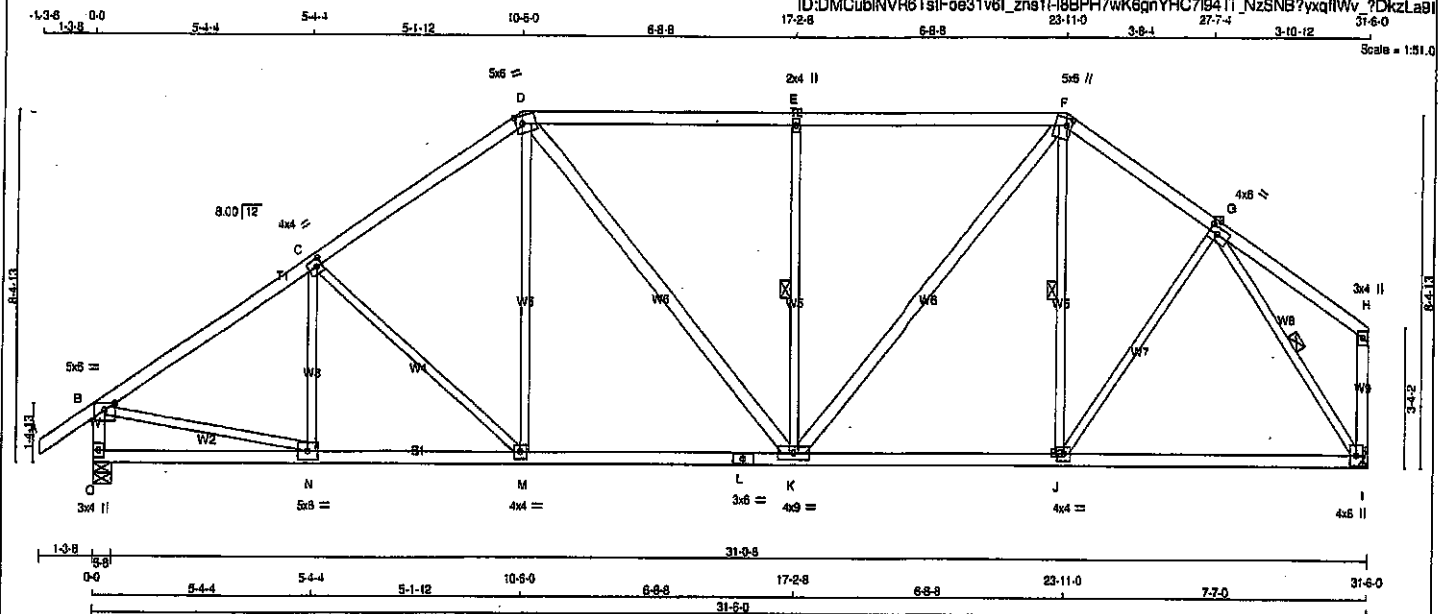

TOTAL WEIGHT = 148 lb

LUMBER			
N.L.G.A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
O - B	2x4	DRY	No.2
I - H	2x4	DRY	No.2
O - L	2x4	DRY	No.2
L - I	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
D - K	2x4	DRY	No.2
K - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	Edge	
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TTVW-m	MT20	5.0	6.0	2.25	2.00
E	TMVW-w	MT20	2.0	4.0		
F	TTVW-m	MT20	5.0	6.0	2.00	1.50
G	TMVW-t	MT20	4.0	6.0	2.00	2.50
H	TMVW-p	MT20	3.0	4.0		
I	BMVW1-p	MT20	4.0	6.0		
J	BMVW-t	MT20	4.0	4.0		
K	BMVW-w	MT20	4.0	9.0		
L	BS-t	MT20	3.0	6.0		
M	BMVW-t	MT20	4.0	4.0		
N	BMVW-t	MT20	5.0	6.0		
O	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	
O	1862	0	1862	0	5-8
I	1735	0	1735	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3-8.

UNFACTORED REACTIONS

JT	1ST LOASE	MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
O	1315	876 / 0	0 / 0	0 / 0	0 / 0	439 / 0	0 / 0
I	1228	806 / 0	0 / 0	0 / 0	0 / 0	422 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.32 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-K, F-J, G-I.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8 -91.8	0.12 (1)	10.00	N-C	-250 / 0	0.09 (1)
B-C	-2050 / 0	-91.8 -91.8	0.40 (1)	4.36	C-M	-302 / 0	0.28 (1)
C-D	-1844 / 0	-91.8 -91.8	0.38 (1)	4.57	M-D	0 / 315	0.07 (1)
D-E	-1740 / 0	-91.8 -91.8	0.59 (1)	4.32	D-K	0 / 382	0.06 (1)
E-F	-1740 / 0	-91.8 -91.8	0.59 (1)	4.32	K-E	-758 / 0	0.34 (1)
F-G	-1527 / 0	-91.8 -91.8	0.19 (1)	5.15	K-F	0 / 771	0.12 (1)
G-H	0 / 22	-91.8 -91.8	0.21 (1)	10.00	J-G	-125 / 39	0.08 (1)
H-I	-1819 / 0	0.0 0.0	0.19 (1)	6.20	J-H	0 / 398	0.08 (1)
I-H	-136 / 0	0.0 0.0	0.09 (1)	7.61	B-N	0 / 1766	0.40 (1)
				G-I	-1870 / 0	0.57 (1)	
O-N	0 / 0	-18.5 -18.5	0.11 (4)	10.00			
N-M	0 / 1731	-18.5 -18.5	0.36 (1)	10.00			
M-L	0 / 1510	-18.5 -18.5	0.32 (1)	10.00			
L-K	0 / 1510	-18.5 -18.5	0.32 (1)	10.00			
K-J	0 / 1249	-18.5 -18.5	0.35 (4)	10.00			
J-I	0 / 1057	-18.5 -18.5	0.33 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. GC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.05")
CALCULATED VERT. DEFL.(LL) = L/989 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (1.05")
CALCULATED VERT. DEFL.(TL) = L/989 (0.15")

CSI: TC=0.59/1.00 (D-E:1), BC=0.36/1.00 (M-N:1), WB=0.57/1.00 (G-I:1), SI=0.30/1.00 (D-E:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 619 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (B) (INPUT = 0.90)
JSI METAL= 0.48 (I) (INPUT = 1.00)

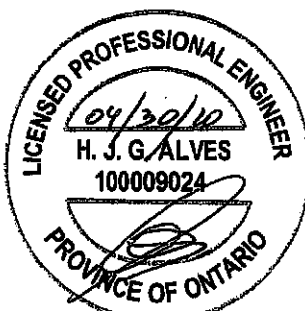

Structural component only
DWG# T-2008038



TOTAL WEIGHT = 158 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR

SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(56 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF
LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360 (1.05")$
CALCULATED VERT. DEFL. (LL) = $L/999 (0.07")$
ALLOWABLE DEFL. (TL) = $L/360 (1.05")$
CALCULATED VERT. DEFL. (TL) = $L/989 (0.13")$

CSI: TC=0.59/(1.0) (B-C:1), SC=0.37/(1.0) (O-P:1),
WB=0.41/(1.0) (H-K:1), SS=0.23/(1.0) (B-C:1)

DOL LUMBER=1.0 NAIL=1.5 L/S LEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10
COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT
RESPONSIBLE FOR QUALITY CONTROL IN THE
TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1687 788	1597 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T41	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:05:32 2020 Page 1
ID:DMCubINVR6TstFos31v6l_zns1l-mKloUTxyt_vPvMixjo_xWbWapBkKgJISIZmAZLa9H

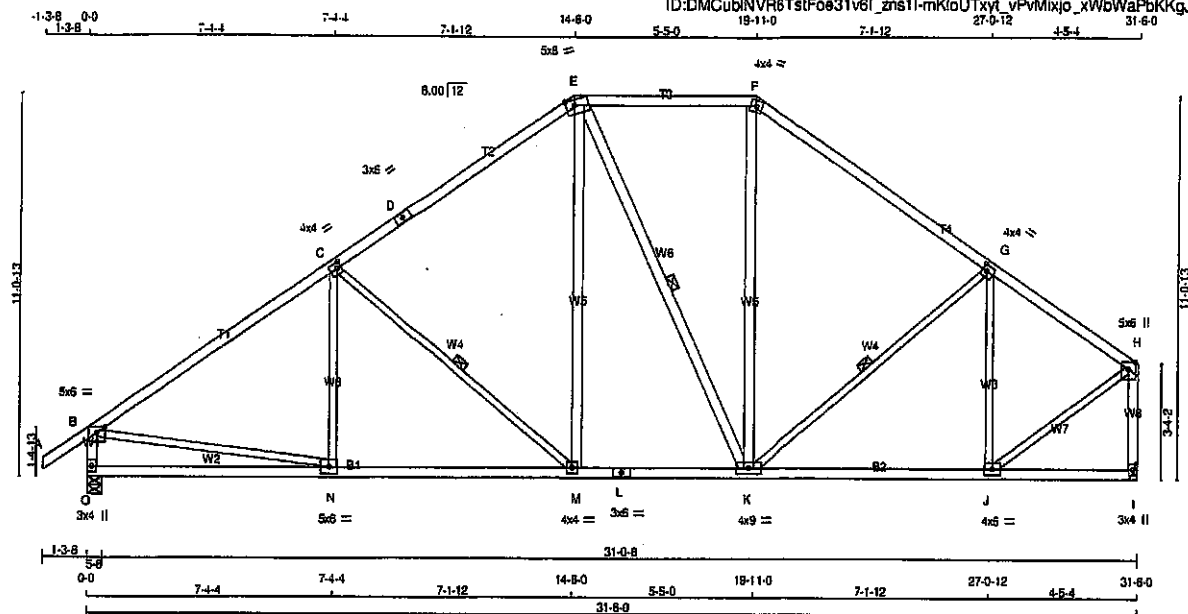

Scale = 1:81.9

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
O - B	2x4	DRY	No.2
I - H	2x4	DRY	No.2
O - L	2x4	DRY	No.2
L - I	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
M - E	2x4	DRY	No.2
E - K	2x4	DRY	No.2
K - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	Edge	
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TS-t	MT20	3.0	6.0		
E	TTVW-m	MT20	5.0	8.0	2.00	3.00
F	TTVW-m	MT20	4.0	4.0		
G	TMVW-t	MT20	4.0	4.0	2.00	1.50
H	TMVW-p	MT20	5.0	6.0	Edge	
I	BMV1-p	MT20	3.0	4.0		
J	BMVW-t	MT20	4.0	6.0		
K	BMVW-t	MT20	4.0	9.0		
L	BS-t	MT20	3.0	6.0		
M	BMVW-t	MT20	4.0	4.0		
N	BMVW-t	MT20	5.0	6.0		
O	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
O	1862	0	1862	0	5-8
I	1736	0	1736	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3-8.

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
O	1315	876 / 0	0 / 0	0 / 0	0 / 0	439 / 0	0 / 0
I	1228	808 / 0	0 / 0	0 / 0	0 / 0	422 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-M, E-K, G-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LC1 MAX (LC)	UNBRACED LENGTH (FT)
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	N-C	-102 / 89	0.07 (1)
B-C	-2080 / 0	-91.8	-91.8 0.83 (1)	3.72	C-M	-634 / 0	0.40 (1)
C-D	-1583 / 0	-91.8	-91.8 0.73 (1)	4.28	M-E	0 / 508	0.08 (1)
D-E	-1583 / 0	-91.8	-91.8 0.73 (1)	4.28	E-K	-176 / 0	0.14 (1)
E-F	-1191 / 0	-91.8	-91.8 0.37 (1)	5.41	K-F	0 / 279	0.04 (1)
F-G	-1482 / 0	-91.8	-91.8 0.64 (1)	4.60	K-G	-5 / 7	0.00 (1)
G-H	-1376 / 0	-91.8	-91.8 0.49 (1)	4.91	J-G	-689 / 0	0.44 (1)
C-B	-1807 / 0	0.0	0.0 0.19 (1)	8.22	B-N	0 / 1770	0.40 (1)
I-H	-1710 / 0	0.0	0.0 0.32 (1)	6.36	J-H	0 / 1441	0.32 (1)
O-N	0 / 0	-18.5	-18.5 0.25 (4)	10.00			
N-M	0 / 1751	-18.5	-18.5 0.41 (1)	10.00			
M-L	0 / 1268	-18.5	-18.5 0.29 (1)	10.00			
L-K	0 / 1268	-18.5	-18.5 0.29 (1)	10.00			
K-J	0 / 1191	-18.5	-18.5 0.28 (1)	10.00			
J-I	0 / 0	-18.5	-18.5 0.16 (4)	10.00			

TOTAL WEIGHT = 155 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 085-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.05")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (1.05")
CALCULATED VERT. DEFL.(TL) = L/999 (0.16")

CSI: TO=0.83/1.00 (B-C:1), BC=0.41/1.00 (M-N:1), WB=0.44/1.00 (G-J:1), SSI=0.27/1.00 (B-C:1)

DDL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1887 788 1997 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (B) (INPUT = 0.90)
JSI METAL = 0.55 (H) (INPUT = 1.00)



Structural component only
DWG# T-2008040

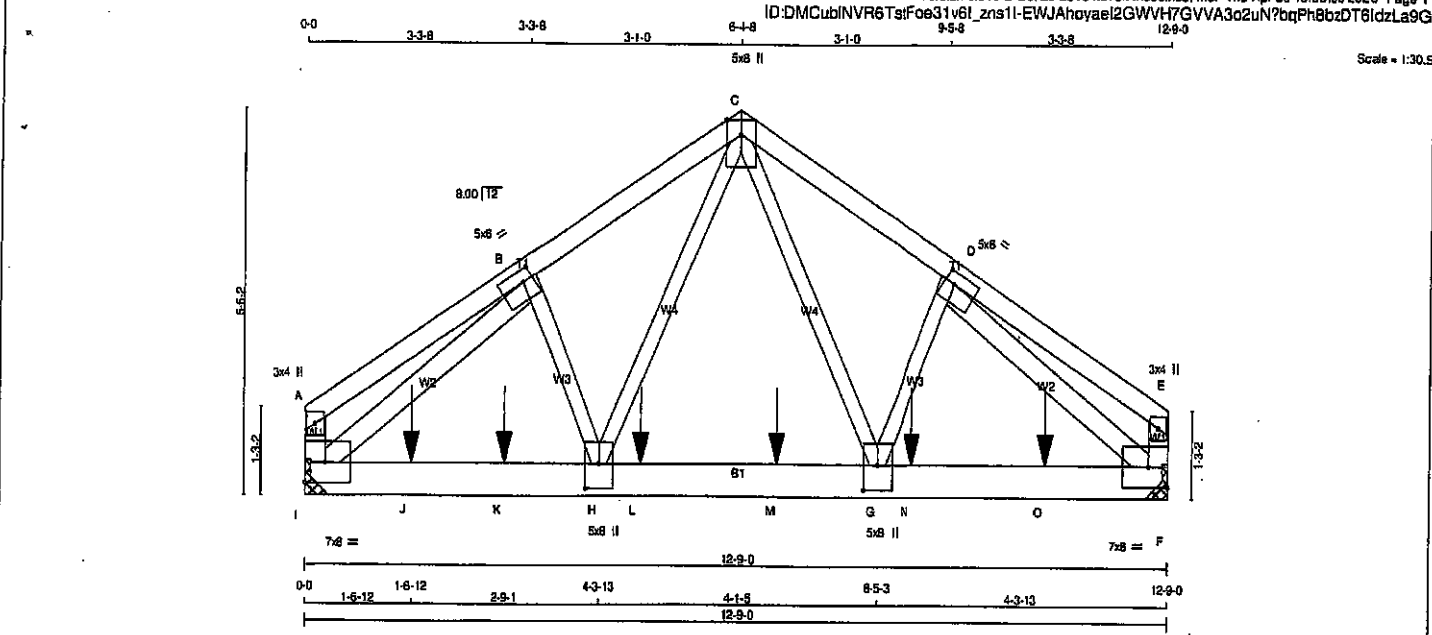

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
I - A	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
I - F	2x6	DRY	1650F 1.5E	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
I - B	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.
DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C 1	12	TOP
C-E 1	12	TOP
I-A 1	12	TOP
F-E 1	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
I-F 2	12	SIDE (0.0)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3 1	6	
2x4 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PILES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT		RECORD	
JT	VERT	HORIZ	DOWN	HORIZ	UPLIFT	BRG	BRG	IN-SX	IN-SX
I	6126	0	6126	0	0	MECHANICAL			
F	5588	0	5588	0	0	MECHANICAL			

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I, F. MINIMUM BEARING LENGTH AT JOINT I = 4-0, JOINT F = 4-0.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	4327	2870 / 0	0 / 0	0 / 0	0 / 0	1457 / 0	0 / 0
F	3947	2818 / 0	0 / 0	0 / 0	0 / 0	1329 / 0	0 / 0

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.70 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	-3 / 1	-91.8 -91.8	0.08 (1)	10.00	C-G	0 / 3327	0.41 (1)
B-C	-6393 / 0	-91.8 -91.8	0.24 (1)	3.70	G-D	0 / 857	0.11 (1)
C-D	-6154 / 0	-91.8 -91.8	0.22 (1)	3.78	H-C	0 / 3582	0.48 (1)
D-E	-2 / 3	-91.8 -91.8	0.08 (1)	10.00	B-H	0 / 903	0.11 (1)
I-A	-142 / 0	0.0 0.0	0.01 (1)	7.81	I-B	-6839 / 0	0.78 (1)
F-E	-189 / 0	0.0 0.0	0.01 (1)	7.81	D-F	-6588 / 0	0.73 (1)
I-J	0 / 4984	-18.5 -18.5	0.71 (1)	10.00			
J-K	0 / 4984	-18.5 -18.5	0.71 (1)	10.00			
K-H	0 / 4984	-18.5 -18.5	0.71 (1)	10.00			
H-L	0 / 3876	-18.5 -18.5	0.58 (1)	10.00			
L-M	0 / 3876	-18.5 -18.5	0.58 (1)	10.00			
M-G	0 / 3876	-18.5 -18.5	0.58 (1)	10.00			
G-N	0 / 4802	-18.5 -18.5	0.82 (1)	10.00			
N-O	0 / 4802	-18.5 -18.5	0.82 (1)	10.00			
O-F	0 / 4802	-18.5 -18.5	0.82 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
J	1-6-12	-1718	-1718	---	FRONT	VERT	TOTAL
K	2-11-4	-1718	-1718	---	FRONT	VERT	TOTAL
L	4-11-4	-1718	-1718	---	FRONT	VERT	TOTAL
M	6-11-4	-1718	-1718	---	FRONT	VERT	TOTAL
N	8-11-4	-1718	-1718	---	FRONT	VERT	TOTAL
O	10-11-4	-1718	-1718	---	FRONT	VERT	TOTAL

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.43")
CALCULATED VERT. DEFL. (LL) = L/999 (0.06")
ALLOWABLE DEFL. (TL) = L/360 (0.43")
CALCULATED VERT. DEFL. (TL) = L/999 (0.12")

CSI: TC=0.24/1.00 (B-C:1), BC=0.71/1.00 (H-I:1), WB=0.76/1.00 (B-I:1), SS=0.88/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP (DRY)	SHEAR	SECTION	(PSI)	(PL)
MT20	MAX	MIN	MAX	MIN	MAX
618	354	1657	789	1987	1856

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.87 (B) (INPUT = 0.90)
JSI METAL = 0.82 (B) (INPUT = 1.00)



Structural component only
DWG# T-2008041 1/2


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T42	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 M Tek Industries, Inc. Thu Apr 30 10:05:33 2020 Page 2
ID:DMCubINVR6TstFoe31v6I zns1I-EWJAHoyael2GWVH7GVVA3o2uN?bqPh8bzDT6ldzLa9G

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B	TMWW-I	MT20	5.0	6.0	2.00	1.75
C	TTWW+p	MT20	5.0	8.0	Edge	
D	TMWW-I	MT20	5.0	6.0	2.00	1.75
E	TMV+p	MT20	3.0	4.0		
F	BMVW1-I	MT20	7.0	8.0	Edge	
G	BMVW+I	MT20	5.0	8.0	4.25	2.50
H	BMVW+I	MT20	5.0	8.0	4.25	2.50
I	BMVW1-I	MT20	7.0	8.0	Edge	

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

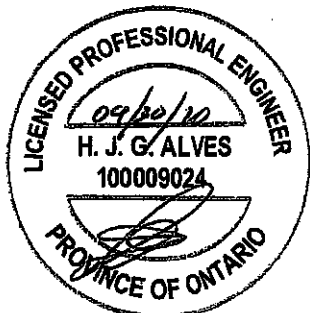


Structural component only
DWG# T-2008041 3/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408316	T43S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.510 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:05:34 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-jlYv8zCPbA78fsKqC0Pc0b5zP3m8HLKICgq3zLa9F

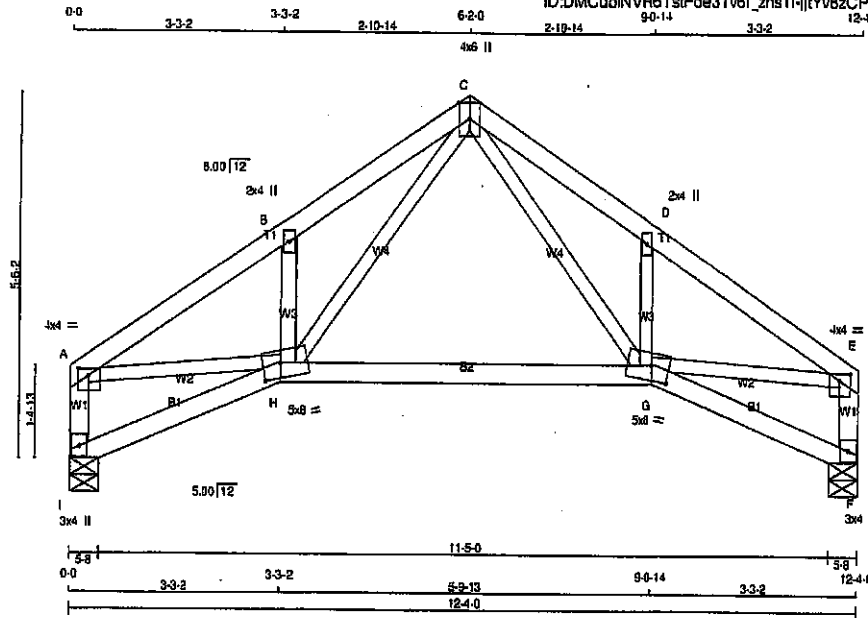

Scale: 3/8"=1'

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
I - A	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
I - H	2x4	DRY	No.2	SPF	
H - G	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWV-p	MT20	4.0	4.0	1.25	2.00
B	TMWV-w	MT20	2.0	4.0		
C	TTWV-p	MT20	4.0	6.0	Edge	
D	TMWV-w	MT20	2.0	4.0		
E	TMWV-p	MT20	4.0	4.0		
F	BMV1-p	MT20	3.0	4.0		
G	BBWWV-m	MT20	5.0	8.0	2.75	3.25
H	BBWWV-m	MT20	5.0	8.0	2.75	3.25
I	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
I	680	0	0	5-8
F	680	0	0	5-8

UNFACTORED REACTIONS	1ST LCASE	MAX./MIN. COMPONENT REACTIONS	PERM.LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
I	481	316/0	0/0	0/0	0/0	165/0
F	481	316/0	0/0	0/0	0/0	165/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.13 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX. UNBRAC	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD	PLP	CSI (LC)	LENGTH	FR-TO	MEMB.	FORCE (LBS)
A-B	-973/0	-91.8	-91.8	0.12 (1)	6.13	C-G	0/551	0.12 (1)
B-C	-1008/0	-91.8	-91.8	0.10 (1)	6.13	G-D	-339/0	0.05 (1)
C-D	-1008/0	-91.8	-91.8	0.10 (1)	6.13	H-E	0/551	0.12 (1)
D-E	-973/0	-91.8	-91.8	0.12 (1)	6.13	H-E	-339/0	0.05 (1)
E-F	-650/0	0.0	0.0	0.07 (1)	7.81	A-H	0/622	0.18 (1)
F-G	-650/0	0.0	0.0	0.07 (1)	7.81	G-E	0/622	0.18 (1)
I-H	0/0	-18.5	-18.5	0.06 (4)	10.00			
H-G	0/502	-18.5	-18.5	0.22 (4)	10.00			
G-F	0/0	-18.5	-18.5	0.06 (4)	10.00			

TOTAL WEIGHT = 50 lb (M.F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.41")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.02")
ALLOWABLE DEFL.(TL) = $L/360$ (0.41")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.08")

CSI: TC=0.12/1.00 (A-B:1), BC=0.22/1.00 (G-H:4), WB=0.18/1.00 (A-H:1), SS=0.11/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1557 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (A) (INPUT = 0.90)
JSI METAL = 0.28 (A) (INPUT = 1.00)




Structural component only
DWG# T-2008042

JOB NAME 408316	TRUSS NAME T43SX	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	---------------------	---------------	----------	-------------------------------	----------

Yamarrack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTak Industries, Inc. Thu Apr 30 10:05:34 2020 Page 1
ID:DMCubINVR6TstFoa31v6I_zns11-jtYv8zCPbA78fsKqC0Pc0b4eP3i8G7kCtCqQ3zLa9F

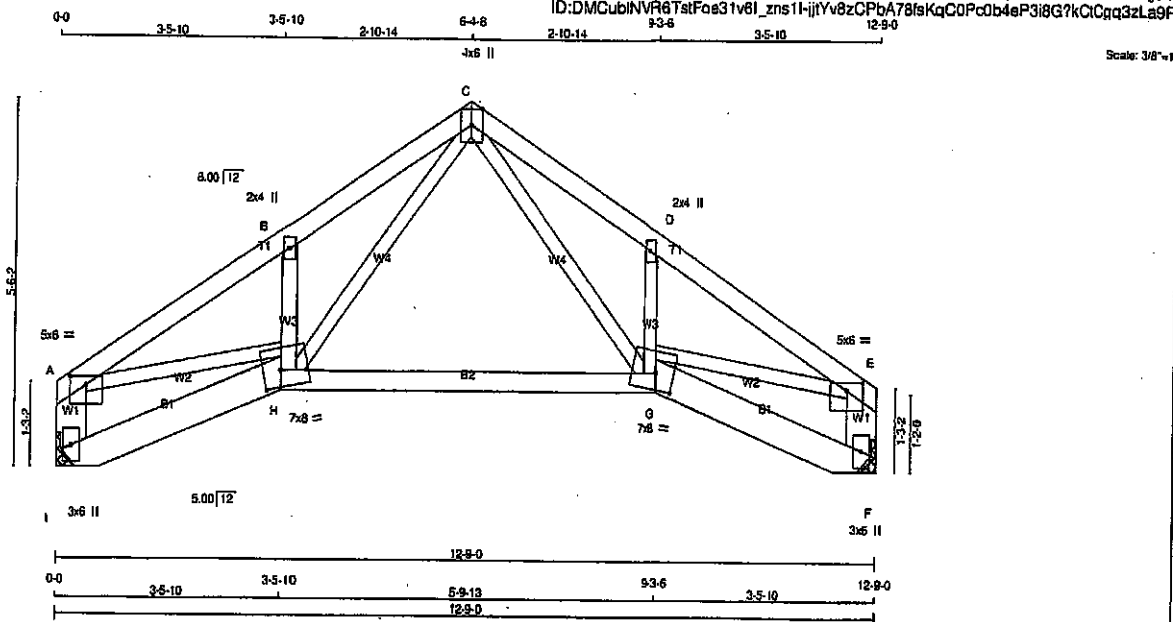

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2		
C - E	2x4	DRY	No.2		
I - A	2x6	DRY	No.2		
F - E	2x6	DRY	No.2		
I - H	2x6	DRY	No.2		
H - G	2x4	DRY	No.2		
G - F	2x6	DRY	No.2		
ALL WEBS	2x3	DRY	No.2		

EXCEPT
GRAY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
A - TMVW-p	MT20	5.0	8.0	1.50	3.00	
B - TMW-w	MT20	2.0	4.0			
C - TTWW-p	MT20	4.0	6.0	Edge		
D - TMW-w	MT20	2.0	4.0			
E - TMVW-p	MT20	5.0	6.0	1.50	3.00	
F - BMV1-p	MT20	3.0	6.0			
G - BBWWW-m	MT20	7.0	8.0	3.00	3.25	
H - BBWWW-m	MT20	7.0	8.0	3.00	3.25	
I - BMV1-p	MT20	3.0	6.0			

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG
	VERT	HORZ	UPLIFT	IN-SX
I	703	0	703	0
F	703	0	703	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I, F. MINIMUM BEARING LENGTH AT JOINT I = 3-8, JOINT F = 3-8.

UNFACTORED REACTIONS

1ST CASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	497	328 / 0	0 / 0	0 / 0	0 / 0	171 / 0	0 / 0
F	497	328 / 0	0 / 0	0 / 0	0 / 0	171 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.88 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED
MEMB.	FORCE	VERT.	(PLF)	CSI (LC)	UNBRAC	LENGTH	FR-TO	FORCE
FR-TO								
A-B	-1084 / 0	-91.8	-91.8	0.14 (1)	5.92	C-G	0 / 631	0.14 (1)
B-C	-1119 / 0	-91.8	-91.8	0.11 (1)	5.89	G-D	-351 / 0	0.08 (1)
C-D	-1119 / 0	-91.8	-91.8	0.11 (1)	5.89	H-E	0 / 631	0.14 (1)
D-E	-1084 / 0	-91.8	-91.8	0.14 (1)	5.92	H-B	-351 / 0	0.08 (1)
I-A	-871 / 0	0.0	0.0	0.04 (1)	7.61	A-H	0 / 916	0.21 (1)
F-E	-871 / 0	0.0	0.0	0.04 (1)	7.61	G-E	0 / 916	0.21 (1)
I-H	0 / 0	-18.5	-18.5	0.03 (4)	10.00			
H-G	0 / 544	-18.5	-18.5	0.23 (4)	10.00			
G-F	0 / 0	-18.5	-18.5	0.03 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.43")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.03")
ALLOWABLE DEFL. (TL) = $L/360$ (0.43")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.10")

CSI: TC=0.14/1.00 (A-B:1), BC=0.23/1.00 (G-H:4), WB=0.21/1.00 (A-H:1), SS=0.12/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1867
	788	1987	1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.50 (E) (INPUT = 0.90)
JSI METAL= 0.22 (E) (INPUT = 1.00)




Structural component only
DWG# T-2008043

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T44	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:05:35 2020 Page 1
ID:DMCubINVR6TstFoa31y6I_zns1I-BvRw6UzqAvI_mprWOWYe8D7FSoGwtcMURXyDMVzLa9E

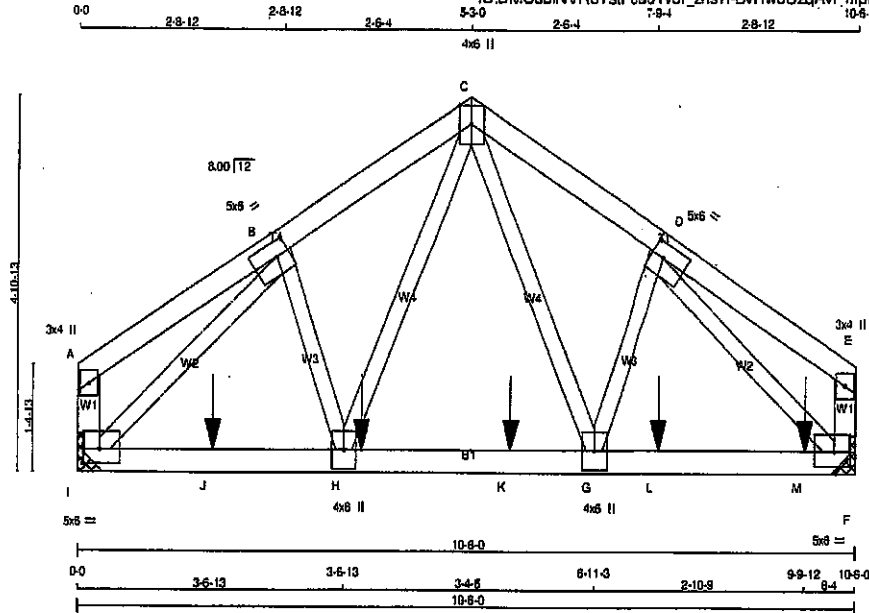

Scale = 1:27.5

LUMBER					DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										DESIGN CRITERIA				TOTAL WEIGHT = 2 X 47 = 93 lb																																					
N. L. G. A. RULES					CHORDS					SIZE					LUMBER					DESCR.					FACTORED					MAXIMUM FACTORED					INPUT					RECORD					SPECIFIED LOADS:					SPACING = 24.0 IN. C/C						
A - C					2x4					DRY					No.2					SPF					GROSS REACTION					GROSS REACTION					BRG					BRG					TOP CH. LL = 26.5 PSF											
C - E					2x4					DRY					No.2					SPF					JT VERT					DOWN					HORIZ					UPLIFT					IN-SX							DL = 6.0 PSF				
I - A					2x4					DRY					No.2					SPF					I 4453					0					4453					0					MECHANICAL							BOT CH. LL = 0.0 PSF				
F - E					2x4					DRY					No.2					SPF					F 5297					0					5297					0					MECHANICAL							DL = 7.4 PSF				
I - F					2x4					DRY					2100F 1.0E					SPF																																				
ALL WEBS					2x3					DRY					No.2					SPF					A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I, F. MINIMUM BEARING LENGTH AT JOINT I = 4-0, JOINT F = 4-0.																															
EXCEPT																																																								

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (#)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	12	TOP
C-E	12	TOP
I-A	12	TOP
F-E	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
I-F	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B	TMWW-1	MT20	5.0	6.0	2.25	2.00

1ST CASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED
I	3145
F	3742

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.45 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	5/0	-91.8	-91.8 0.07 (1)	C-G	0/2469	0.31 (1)	
B-C	-4431/0	-91.8	-91.8 0.14 (1)	G-D	0/1006	0.12 (1)	
C-D	-4422/0	-91.8	-91.8 0.14 (1)	H-C	0/2491	0.31 (1)	
D-E	-5/0	-91.8	-91.8 0.07 (1)	B-H	0/1009	0.12 (1)	
I-A	-128/0	0.0	0.0 0.01 (1)	I-B	-4953/0	0.65 (1)	
F-E	-127/0	0.0	0.0 0.01 (1)	D-F	-4943/0	0.65 (1)	
I-J	0/3361	-18.5	-18.5 0.74 (1)				
J-H	0/3361	-18.5	-18.5 0.74 (1)				
H-K	0/2833	-18.5	-18.5 0.65 (1)				
K-G	0/2833	-18.5	-18.5 0.65 (1)				
G-L	0/3354	-18.5	-18.5 0.65 (1)				
L-M	0/3354	-18.5	-18.5 0.65 (1)				
M-F	0/3354	-18.5	-18.5 0.65 (1)				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
H	3-9-12	-1718	-1718		FRONT	VERT	TOTAL		C1
J	1-9-12	-1718	-1718		FRONT	VERT	TOTAL		C1
K	5-9-12	-1718	-1718		FRONT	VERT	TOTAL		C1
L	7-9-12	-1718	-1718		FRONT	VERT	TOTAL		C1
M	9-9-12	-1721	-1721		FRONT	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/960 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/960 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.14/1.00 (B-C:1), BC=0.74/1.00 (H-I:1), WB=0.65/1.00 (B-I:1), SSI=0.84/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1587 758 1987 1556

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (D) (INPUT = 0.90)
JSI METAL= 0.57 (B) (INPUT = 1.00)



Structural component only
DWG# T-2008044 1/2

CONTINUED ON PAGE 2


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T44	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:05:35 2020 Page 2
ID:DMCubINVR8TstFoe31v8l zns1t-BvRw6UzqAvl mpRWQwYe8D7FS0GwicMuRXyDMVzLa9E

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
C	TTWW+p	MT20	4.0	6.0	Edge	
D	TMWW-i	MT20	5.0	6.0	2.25	2.00
E	TMV+p	MT20	3.0	4.0		
F	BMWW1-i	MT20	5.0	6.0	2.25	2.75
G	BMWW+i	MT20	4.0	6.0		
H	BMWW+i	MT20	4.0	6.0		
I	BMWW1-i	MT20	5.0	6.0	2.25	2.75

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

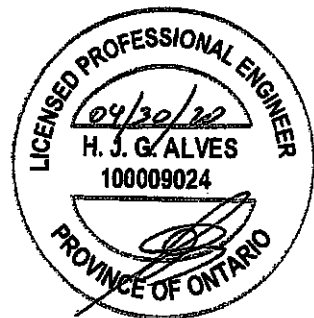

Structural component only
DWG# T-2008044 2/2

JOB NAME 408316 Tamarack Roof Truss, Burlington	TRUSS NAME T45	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---	-------------------	---------------	----------	-------------------------------	-------------	----------

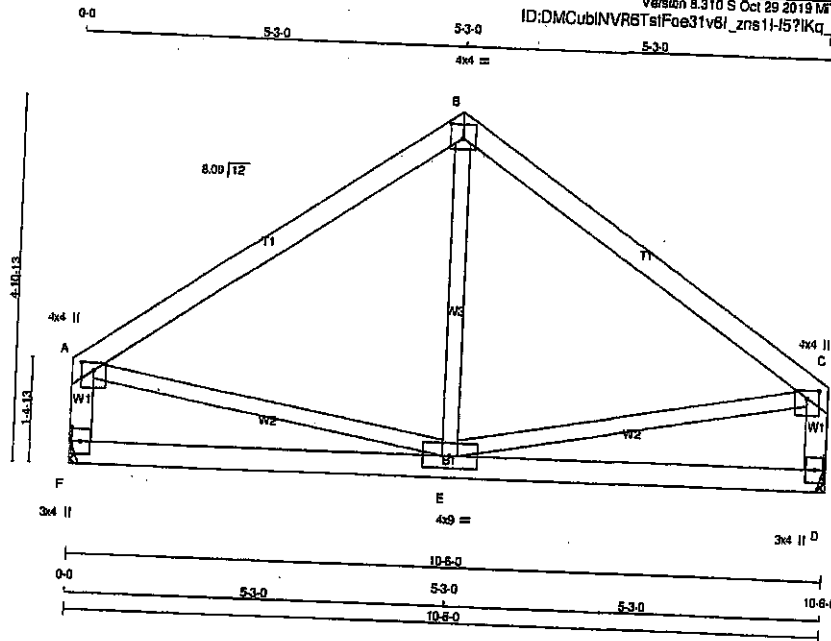

LUMBER		
N. L. G. A. RULES		
CHORDS	SIZE	LUMBER
A - B	2x4	DRY No.2
B - C	2x4	DRY No.2
F - A	2x4	DRY No.2
D - C	2x4	DRY No.2
F - D	2x4	DRY No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TTW-p	MT20	4.0	4.0	2.25	2.00
C	TMVW+p	MT20	4.0	4.0	1.25	2.00
D	BMV+p	MT20	3.0	4.0		
E	BMVW+p	MT20	4.0	9.0		
F	BMV+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

DESCR.	FACTORED	MAXIMUM FACTORED	INPUT	REQD
SPF	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	IN-SX	IN-SX
F	579	0	0	0
D	579	0	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F, D. MINIMUM BEARING LENGTH AT JOINT F = 1-8, JOINT D = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
F	408	269 / 0	0 / 0	0 / 0	141 / 0	0 / 0
D	408	269 / 0	0 / 0	0 / 0	141 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			FACTORED			WEBS		
MEMB.	MAX. FORCE (LBS)		VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO			FROM TO			FR-TO		
A-B	-414 / 0		-91.8	-91.8 0.33 (1)	6.25	E-B	-22 / 82	0.03 (4)
B-C	-414 / 0		-91.8	-91.8 0.33 (1)	6.25	A-E	0 / 352	0.08 (1)
F-A	-541 / 0		0.0	0.0 0.06 (1)	7.81	E-C	0 / 352	0.08 (1)
D-C	-541 / 0		0.0	0.0 0.06 (1)	7.81			
F-E	0 / 0		-18.5	-18.5 0.14 (4)	10.00			
E-D	0 / 0		-18.5	-18.5 0.14 (4)	10.00			

TOTAL WEIGHT = 41 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 5.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.36")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.36")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.02")

CSI: TC=0.33/1.00 (B-C:1), BC=0.14/1.00 (E-F:4), WB=0.08/1.00 (A-E:1), SS=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 786 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.43 (C) (INPUT = 0.90)
JSI METAL = 0.13 (C) (INPUT = 1.00)



Structural component only
DWG# T-2008045

JOB NAME 408316 Tamarack Roof Truss, Burlington	TRUSS NAME T45S	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--	---------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

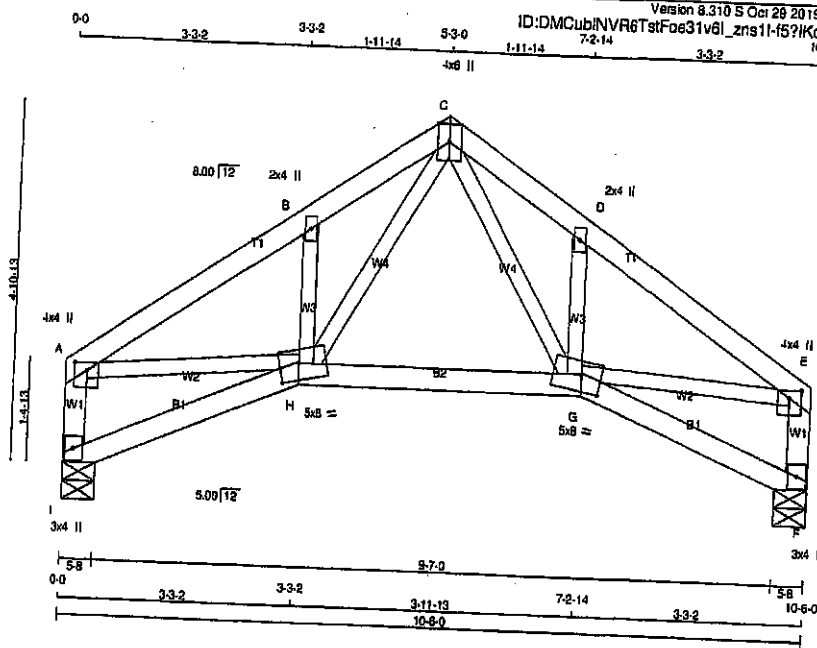

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
I - A	2x4	DRY	No.2
F - E	2x4	DRY	No.2
I - H	2x4	DRY	No.2
H - G	2x4	DRY	No.2
G - F	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TMVW+w	MT20	2.0	4.0		
C	TTWW+p	MT20	4.0	6.0	Edge	
D	TMVW+w	MT20	2.0	4.0		
E	TMVW+p	MT20	4.0	4.0	1.25	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BBWWW-m	MT20	5.0	8.0	2.75	3.25
H	BBWWW-m	MT20	5.0	8.0	2.75	3.25
I	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

BEARINGS

DESIGN	SPF	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	SPF	VERT	HORZ	DOWN	HORZ
I	SPF	579	0	579	0
F	SPF	579	0	579	0

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
I	COMBINED	SNOW	0/0	0/0	141/0	0/0
F	COMBINED	SNOW	0/0	0/0	141/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PL)	LC1 MAX (PL)	MAX. UNBRACED LENGTH (FT)	FR-TO	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	FR-TO
A-B	-778/0	-91.8	-91.8	0.12 (1)	6.25	C-G	0/448	0.10 (1)			
B-C	-813/0	-91.8	-91.8	0.08 (1)	6.25	G-D	-299/0	0.05 (1)			
C-D	-813/0	-91.8	-91.8	0.08 (1)	6.25	H-C	0/448	0.10 (1)			
D-E	-778/0	-91.8	-91.8	0.12 (1)	6.25	H-B	-299/0	0.05 (1)			
I-A	-549/0	0.0	0.0	0.08 (1)	7.81	A-H	0/657	0.15 (1)			
F-E	-549/0	0.0	0.0	0.08 (1)	7.81	G-E	0/657	0.15 (1)			
I-H	0/0	-18.5	-18.5	0.08 (4)	10.00						
H-G	0/435	-18.5	-18.5	0.12 (4)	10.00						
G-F	0/0	-18.5	-18.5	0.08 (4)	10.00						

TOTAL WEIGHT = 44 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.35")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.01")
ALLOWABLE DEFL.(TL) = $L/360$ (0.35")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.04")

CSI: TC=0.12/1.00 (D-E-1), BC=0.12/1.00 (G-H-4), WB=0.15/1.00 (A-H-1), SSI=0.11/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
618 354	1867 768	1987 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.85 (A) (INPUT = 0.80)
JSI METAL = 0.20 (A) (INPUT = 1.00)

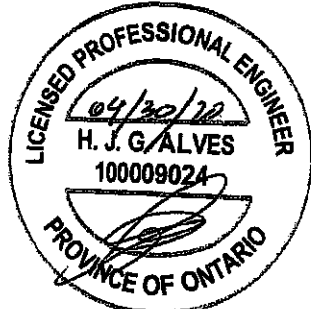

Structural component only
DWG# T-2008046

JOB NAME 408317	TRUSS NAME T50	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 3.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:31 2020 Page 1	
ID:DMCubINVR6TstFoe31v6l_zns11-FaL7yLbXGfYSC7XgK7vsPlopaSwYy8Nz017EzLV6				23-3-14 29-2-8 5-10-10 35-4-8 1-3-8	
				Scale = 1:37.5	

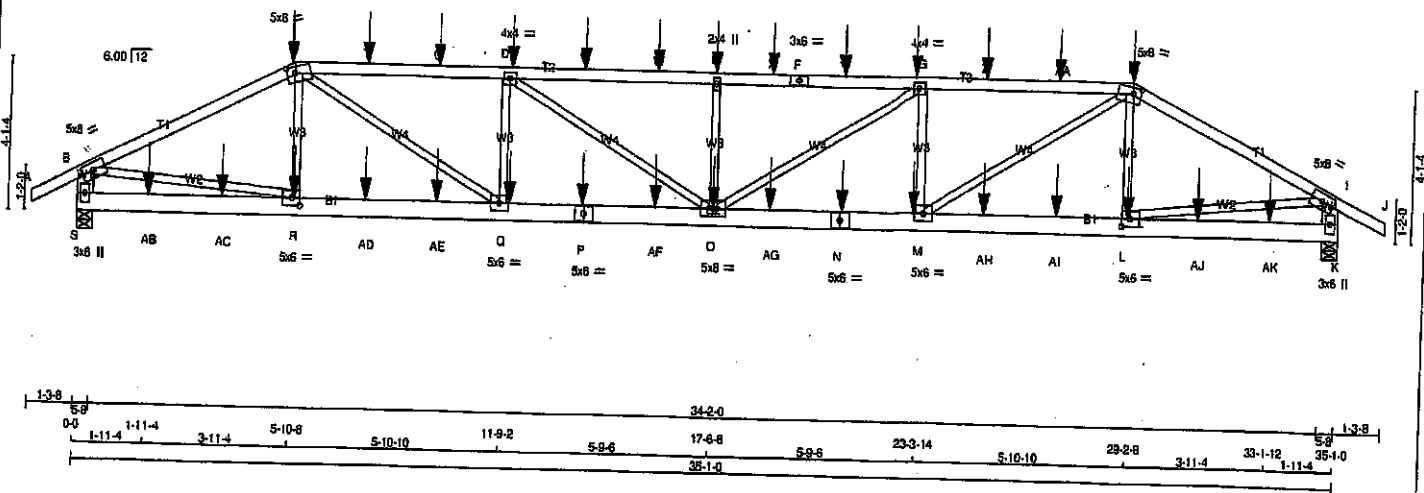

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
S - B	2x6	DRY	No.2
K - I	2x6	DRY	No.2
S - P	2x6	DRY	No.2
P - N	2x6	DRY	No.2
N - K	2x6	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	12	SIDE(61.0)
C-F	12	SIDE(61.0)
F-H	12	SIDE(61.0)
H-J	12	SIDE(61.0)
S-B	12	TOP
K-I	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S-P	12	SIDE(183.1)
P-N	12	SIDE(183.1)
N-K	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	REQD BRG IN-SX
JT	VERT	DOWN	UPLIFT	
S	3303	0	0	5-8
K	3303	0	0	5-8

UNFACTORED REACTIONS

	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	2336	1528 / 0	0 / 0	0 / 0	0 / 0	808.0	0 / 0
K	2336	1528 / 0	0 / 0	0 / 0	0 / 0	808.0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.89 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0 / 28	A-B	0 / 28
B-C	-5023 / 0	B-C	-377 / 33
C-T	-7076 / 0	C-T	0 / 3072
T-U	-7076 / 0	T-U	-1459 / 0
U-D	-7076 / 0	U-D	0 / 916
D-V	-7846 / 0	D-V	0 / 916
V-W	-7846 / 0	V-W	0 / 916
W-E	-7846 / 0	W-E	-1459 / 0
E-X	-7846 / 0	E-X	0 / 3072
X-F	-7846 / 0	X-F	-378 / 33
F-Y	-7846 / 0	F-Y	0 / 4528
Y-G	-7846 / 0	Y-G	0 / 4528
G-Z	-7076 / 0	G-Z	0 / 4528
Z-AA	-7076 / 0	Z-AA	0 / 4528
AA-H	-7076 / 0	AA-H	0 / 4528
H-I	-5023 / 0	H-I	0 / 4528
I-J	0 / 28	I-J	0 / 4528
J-S	-3228 / 0	J-S	0 / 4528
S-K	-3227 / 0	S-K	0 / 4528
K-L	0 / 0	K-L	0 / 4528
S-AB	0 / 0	S-AB	0 / 4528
AB-AC	0 / 0	AB-AC	0 / 4528
AC-R	0 / 0	AC-R	0 / 4528
R-AD	0 / 4480	R-AD	0 / 4528
AD-AE	0 / 4480	AD-AE	0 / 4528
AE-Q	0 / 4480	AE-Q	0 / 4528
Q-P	0 / 7076	Q-P	0 / 4528
P-AF	0 / 7076	P-AF	0 / 4528
AF-O	0 / 7076	AF-O	0 / 4528
O-AG	0 / 7076	O-AG	0 / 4528
AG-N	0 / 7076	AG-N	0 / 4528
N-M	0 / 7076	N-M	0 / 4528
M-AH	0 / 4480	M-AH	0 / 4528
AH-AI	0 / 4480	AH-AI	0 / 4528
AI-L	0 / 4480	AI-L	0 / 4528
L-AJ	0 / 0	L-AJ	0 / 4528
AJ-AK	0 / 0	AJ-AK	0 / 4528
AK-K	0 / 0	AK-K	0 / 4528

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-414	-414	---	FRONT	VERT	TOTAL	---	C1
D	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPC 2011, TPC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.25")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/901 (0.47")

CSI: TC=0.80/1.00 (D-E:1), RC=0.53/1.00 (O-Q:1),
WB=0.58/1.00 (B-R:1), SS=0.20/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)	(PL)
MAX	MIN	MAX	MIN
MT20	618	354	1657
	788	1937	1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (L) (INPUT = 0.90)
JSI METAL = 0.68 (P) (INPUT = 1.00)

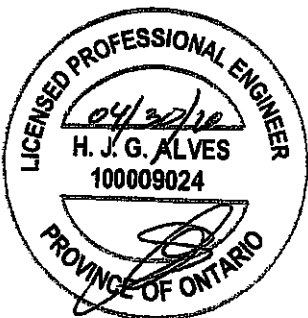

Structural component only
DWG# T-2008054 1/2

CONTINUED ON PAGE 2

JOB NAME 408317	TRUSS NAME T50	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:31 2020 Page 2
 ID:DMCubINVR6TstFoe31v6l zns1l-Fal7yLbxGFySC7XqK7vsPlopaSwYv8jNz0l?E-zl ZV6

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	8.0		
C	TTWW-m	MT20	5.0	8.0	2.00	2.75
D	TMVW-t	MT20	4.0	4.0		
E	TMVW-w	MT20	2.0	4.0		
F	TS-t	MT20	3.0	8.0		
G	TMVW-t	MT20	4.0	4.0		
H	TTWW-m	MT20	5.0	8.0	2.00	2.75
I	TMVW-t	MT20	5.0	8.0		
K	BMV1-p	MT20	3.0	6.0		
L	BMVW-t	MT20	5.0	6.0	2.50	2.75
M	BMVW-t	MT20	5.0	6.0		
N	BS-t	MT20	5.0	6.0		
O	BMVW-t	MT20	5.0	8.0		
P	BS-t	MT20	5.0	6.0		
Q	BMVW-t	MT20	5.0	6.0		
R	BMVW-t	MT20	5.0	6.0	2.50	2.75
S	BMV1-p	MT20	3.0	6.0		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	17-6-8	-110	-110	---	FRONT	VERT	TOTAL	---	C1
G	23-1-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	29-2-8	-414	-110	---	FRONT	VERT	TOTAL	---	C1
L	29-1-12	-28	-26	---	FRONT	VERT	TOTAL	---	C1
M	23-1-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
N	21-1-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
O	17-6-8	-26	-26	---	FRONT	VERT	TOTAL	---	C1
P	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Q	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	19-1-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	21-1-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	25-1-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	27-1-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	1-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AC	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AD	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AE	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AF	15-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	19-1-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	25-1-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	27-1-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	31-1-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	33-1-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
 DWG# T-2008054

JOB NAME: 408317 TRUSS NAME: T51 QUANTITY: 1 PLY: 1 JOB DESC: GREEN PARK HOMES TRUSS DESC: DWG NO. 1

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:32 2020 Page 1

ID: DMCubINVR81stFoe31v6l_zns1HjmuV9hcZ024JqH6surQ5yzKyN_nTHLGacdmQXhZLZV5

Scale = 1:57.5

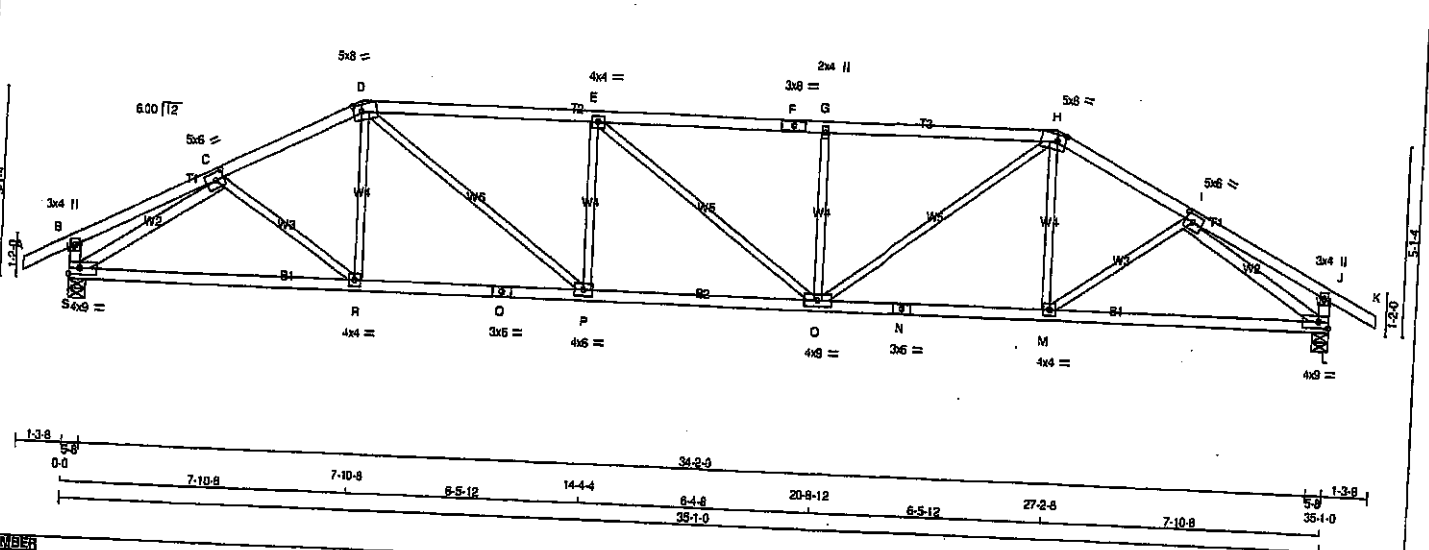

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV-p	MT20	3.0	4.0	
C	TMVW-1	MT20	5.0	8.0	2.50 2.75
D	TTWW-m	MT20	5.0	8.0	2.25 2.75
E	TMVW-1	MT20	4.0	4.0	
F	TS-1	MT20	3.0	8.0	
G	TMVW-m	MT20	2.0	4.0	
H	TTWW-m	MT20	5.0	8.0	2.25 2.75
I	TMVW-1	MT20	5.0	8.0	2.50 2.75
J	TMV-p	MT20	3.0	4.0	
L	BMVW-1	MT20	4.0	9.0	Edge
M	BMVW-1	MT20	4.0	4.0	
N	BS-1	MT20	3.0	6.0	
O	BMVW-1	MT20	4.0	9.0	
P	BMVW-1	MT20	4.0	9.0	
Q	BS-1	MT20	3.0	6.0	
R	BMVW-1	MT20	4.0	4.0	
S	BMVW-1	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REQD
JT VERT	2059	0	0
S VERT	2059	0	0
L VERT	2059	0	0

UNFACTORED REACTIONS

1ST CASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
JT COMBINED	1453	987 / 0	0 / 0	0 / 0	0 / 0
S COMBINED	1453	987 / 0	0 / 0	0 / 0	0 / 0
L COMBINED	1453	987 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.95 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS (LC)	MAX. FACTORED UNBRACED LENGTH	WEBS	MEMB. MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)
FR-TO					FR-TO		
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	C-R	0 / 93	0.03 (4)
B-C	0 / 16	-91.8	-91.8 0.20 (1)	10.00	R-D	0 / 121	0.04 (4)
C-D	-2791 / 0	-91.8	-91.8 0.31 (1)	3.88	D-P	0 / 1258	0.25 (1)
D-E	-3492 / 0	-91.8	-91.8 0.93 (1)	2.95	P-E	-541 / 0	0.25 (1)
E-F	-3491 / 0	-91.8	-91.8 0.92 (1)	2.95	E-O	-2 / 0	0.00 (1)
F-G	-3491 / 0	-91.8	-91.8 0.93 (1)	2.97	O-G	-640 / 0	0.25 (1)
G-H	-3491 / 0	-91.8	-91.8 0.92 (1)	2.95	G-H	0 / 1256	0.25 (1)
H-I	-2791 / 0	-91.8	-91.8 0.31 (1)	3.89	H-M	0 / 121	0.04 (4)
I-J	0 / 16	-91.8	-91.8 0.20 (1)	10.00	M-I	0 / 93	0.03 (4)
J-K	0 / 28	-91.8	-91.8 0.12 (1)	10.00	S-C	-2988 / 0	0.82 (1)
S-B	-270 / 0	0.0	0.0 0.03 (1)	7.81	I-L	-2986 / 0	0.82 (1)
L-J	-270 / 0	0.0	0.0 0.03 (1)	7.81			
S-R	0 / 2411	-18.5	-18.5 0.93 (1)	10.00			
R-O	0 / 2481	-18.5	-18.5 0.54 (1)	10.00			
Q-P	0 / 2481	-18.5	-18.5 0.54 (1)	10.00			
P-O	0 / 3492	-18.5	-18.5 0.94 (1)	10.00			
O-N	0 / 2482	-18.5	-18.5 0.54 (1)	10.00			
N-M	0 / 2482	-18.5	-18.5 0.54 (1)	10.00			
M-L	0 / 2411	-18.5	-18.5 0.93 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCO 2010, NBCO 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")

CALCULATED VERT. DEFL. (LL) = L/998 (0.21")

ALLOWABLE DEFL. (TL) = L/360 (1.17")

CALCULATED VERT. DEFL. (TL) = L/998 (0.41")

CSI: TC=0.92/1.00 (D-E-1), EC=0.84/1.00 (O-P-1), WS=0.82/1.00 (I-L-1), SS=0.28/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354
MT20	1687	788
MT20	1687	1655

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (L) (INPUT = 0.90)


JSI METAL = 0.77 (N) (INPUT = 1.00)

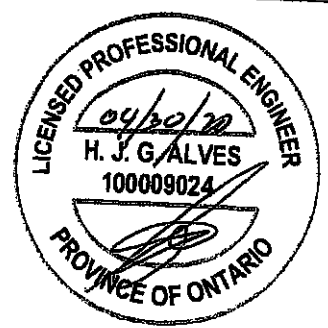

Structural component only
DWG# T-2008055

JOB NAME: 408317 TRUSS NAME: T52 QUANTITY: 1 PLY: 1 JOB DESC: GREEN PARK HOMES TRUSS DESC: Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:33 2020 Page 1
 ID:DMCubINVR6TsFo831v6I zns1f-BvSim1dBnsDARRh2RYxKUA7kO9n0rJ0rHV_37zLZV4
 35-1-0 36-4-8 1-3-8 Scale = 1:57.6

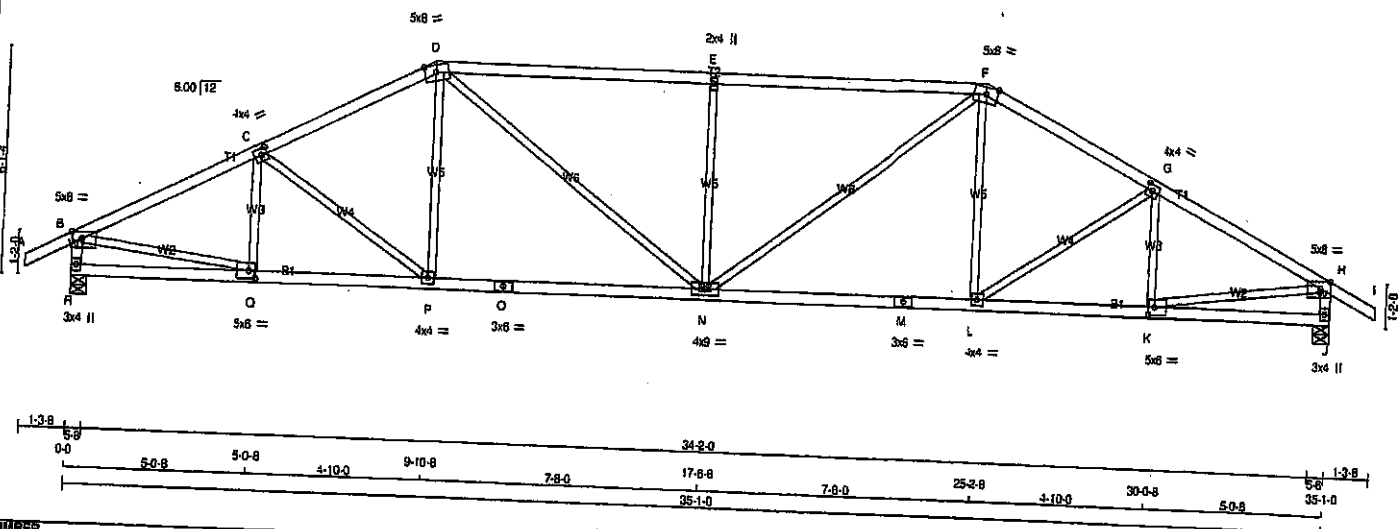

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
A - D	2x4	DRY No.2
D - F	2x4	DRY No.2
F - I	2x4	DRY No.2
R - B	2x4	DRY No.2
J - H	2x4	DRY No.2
R - O	2x4	DRY No.2
O - M	2x4	DRY No.2
M - J	2x4	DRY No.2

ALL WEBS 2x3 DRY No.2
 EXCEPT
 DRY, SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMWV-p	MT20	5.0	8.0	Edge	3.50
C TMWV-w	MT20	4.0	4.0	2.00	1.75
D TTWV-m	MT20	5.0	8.0	2.25	3.75
E TMWV-w	MT20	2.0	4.0		
F TTWV-m	MT20	5.0	8.0	2.25	3.75
G TMWV-w	MT20	4.0	4.0	2.00	1.75
H TMWV-p	MT20	5.0	8.0	Edge	3.50
J BMV1-p	MT20	3.0	4.0		
K BMWV-l	MT20	5.0	6.0	2.50	2.00
L BMWV-l	MT20	4.0	4.0		
M BS-l	MT20	3.0	6.0		
N BMWVW-l	MT20	4.0	9.0		
O BS-l	MT20	3.0	6.0		
P BMWV-l	MT20	4.0	4.0		
Q BMWV-l	MT20	5.0	6.0	2.50	2.00
R BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	2059	0	2059	0
R HORZ	0	2059	0	0
J UPLIFT	0	0	5-8	5-8

UNFACTORED REACTIONS

	1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	SNOW	LIVE
R	1453	967 / 0
J	1453	967 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.83 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO				FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	Q-C	-352 / 0	10.00	0.08 (1)
B-C	-2826 / 0	-91.8	-91.8 0.39 (1)	C-P	-211 / 0	3.81	0.13 (1)
C-D	-2679 / 0	-91.8	-91.8 0.37 (1)	P-D	0 / 246	3.92	0.08 (4)
D-E	-3044 / 0	-91.8	-91.8 0.96 (1)	D-N	0 / 636	2.83	0.19 (1)
E-F	-3044 / 0	-91.8	-91.8 0.96 (1)	N-E	-867 / 0	2.83	0.51 (1)
F-G	-2878 / 0	-91.8	-91.8 0.37 (1)	E-F	0 / 838	3.92	0.19 (1)
G-H	-2826 / 0	-91.8	-91.8 0.39 (1)	F-F	0 / 246	3.81	0.08 (4)
H-I	0 / 28	-91.8	-91.8 0.12 (1)	L-G	-211 / 0	10.00	0.13 (1)
R-B	-2014 / 0	0.0	0.0 0.20 (1)	K-G	-352 / 0	5.95	0.08 (1)
J-H	-2014 / 0	0.0	0.0 0.20 (1)	B-Q	0 / 2584	5.95	0.58 (1)
R-Q	0 / 0	-18.5	-18.5 0.10 (4)	K-H	0 / 2584	5.95	0.58 (1)
O-P	0 / 2548	-18.5	-18.5 0.50 (1)				
P-O	0 / 2378	-18.5	-18.5 0.49 (1)				
O-N	0 / 2378	-18.5	-18.5 0.49 (1)				
N-M	0 / 2378	-18.5	-18.5 0.49 (1)				
M-L	0 / 2378	-18.5	-18.5 0.49 (1)				
L-K	0 / 2548	-18.5	-18.5 0.50 (1)				
K-J	0 / 0	-18.5	-18.5 0.10 (4)				

TOTAL WEIGHT = 138 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(56 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.17")
 ALLOWABLE DEFL.(TL) = L/380 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.34")

CSI: TC=0.98/1.00 (D-E:1), BC=0.50/1.00 (P-Q:1), WB=0.58/1.00 (B-Q:1), SS=0.34/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1687	788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.86 (F) (INPUT = 0.90)
 JSI METAL = 0.75 (O) (INPUT = 1.00)




Structural component only
 DWG# T-2008056

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408317	T53	1	2	GREEN PARK HOMES	
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 11:40:05 2020 Page 1
ID:DMCubINVR6TsFoe31v6l zns1t-A1Q7GbQ0f7AuFYfGGxvz60CQZMu0TFoRENSzLYme

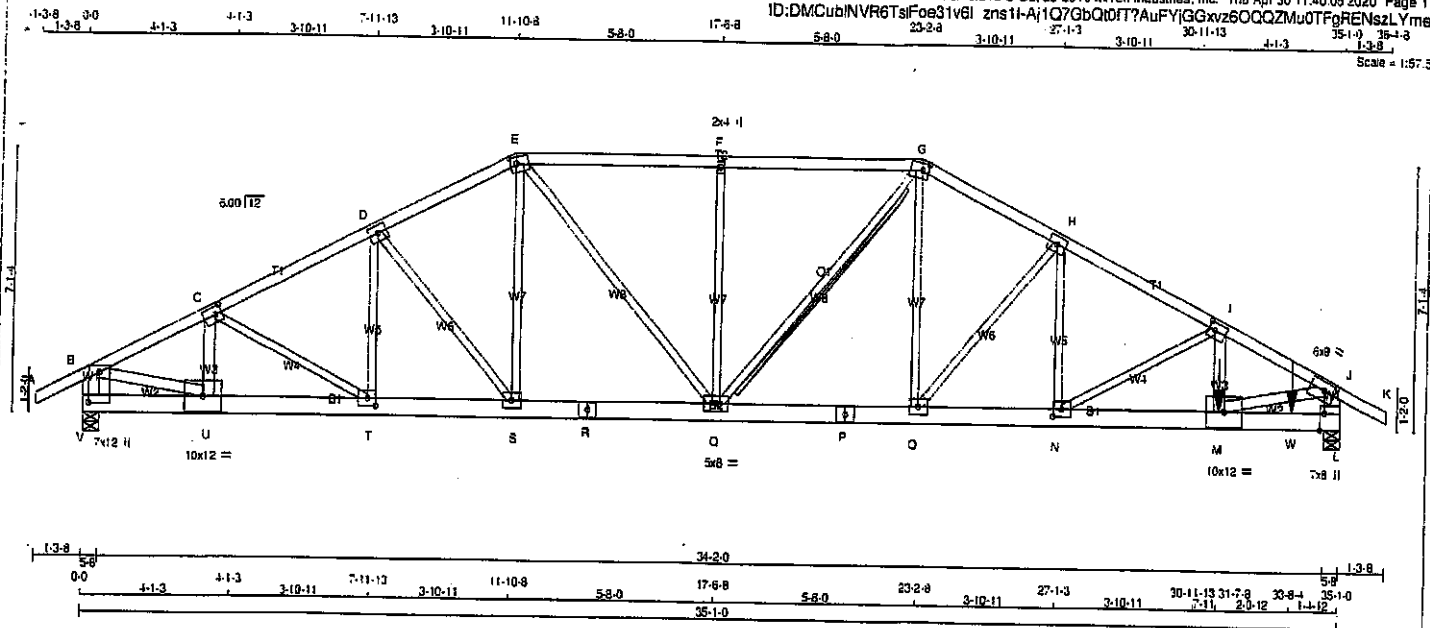

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DRY
A - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - K	2x4	DRY	No.2
V - B	2x6	DRY	No.2
L - J	2x6	DRY	No.2
V - R	2x6	DRY	No.2
R - P	2x6	DRY	No.2
P - L	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
U - C	2x4	DRY	No.2
M - I	2x4	DRY	No.2
B - U	2x4	DRY	No.2
M - J	2x4	DRY	No.2

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122'X3") SPIRAL NAILS		
A-E	12	TOP
E-G	12	TOP
G-K	12	TOP
V-B	12	TOP
L-J	12	TOP
BOTTOM CHORDS : (0.122'X3") SPIRAL NAILS		
V-R	12	TOP
R-P	12	TOP
P-L	6	SIDE(427.3)
WEBS : (0.122'X3") SPIRAL NAILS		
2x3	8	SIDE(1083.7)
1x4	2	
2x4	1	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG
V	2849	0	0	2849	0	0	0	IN-SX	IN-SX
L	7868	0	0	7868	0	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS								
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
V	1870	1245	0	0	0	0	0	625	0
L	5554	3702	0	0	0	0	0	1852	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.59 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

2x4 DRY SPF NO.2 T-BRACE AT G-Q

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO				FR-TO			
A-B	0 28	-91.8	-91.8 0.07 (1)	U-C	-692 0	0.04 (1)	
B-C	-3900 0	-91.8	-91.8 0.14 (1)	C-T	0 326	0.04 (1)	
C-D	-3931 0	-91.8	-91.8 0.19 (1)	T-D	-82 33	0.02 (1)	
D-E	-3718 0	-91.8	-91.8 0.18 (1)	D-S	-331 0	0.11 (1)	
E-F	-4114 0	-91.8	-91.8 0.37 (1)	S-E	0 367	0.05 (1)	
F-G	-4114 0	-91.8	-91.8 0.37 (1)	O-G	0 2035	0.25 (1)	
G-H	-4803 0	-91.8	-91.8 0.23 (1)	O-H	-2534 0	0.86 (1)	
H-I	-6580 0	-91.8	-91.8 0.34 (1)	N-H	0 2276	0.28 (1)	
I-J	-10933 0	-91.8	-91.8 0.53 (1)	M-I	-4330 0	0.97 (1)	
J-K	0 28	-91.8	-91.8 0.07 (1)	B-U	0 3662	0.32 (1)	
V-B	-2591 0	0.0	0.0 0.09 (1)	M-J	0 3314	0.29 (1)	
L-J	-7297 0	0.0	0.0 0.26 (1)	Q-G	-297 0	0.12 (1)	
				O-Q	0 1243	0.15 (1)	
				Q-F	-530 0	0.26 (1)	
V-U	0 0	-18.5	-18.5 0.03 (1)				
U-T	0 3234	-18.5	-18.5 0.25 (1)				
T-S	0 3519	-18.5	-18.5 0.25 (1)				
S-R	0 3312	-18.5	-18.5 0.23 (1)				
R-Q	0 3312	-18.5	-18.5 0.23 (1)				
Q-P	0 4305	-18.5	-18.5 0.30 (1)				
P-O	0 4305	-18.5	-18.5 0.30 (1)				
O-N	0 5900	-18.5	-18.5 0.39 (1)				
N-M	0 9690	-18.5	-18.5 0.79 (1)				
M-W	0 0	-18.5	-18.5 0.29 (1)				
W-L	0 0	-18.5	-18.5 0.29 (1)				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	HEEL	CONN.
M	31-7-8	-5715	-5715	---	BACK	VERT	---	C1
W	33-8-4	-684	-684	---	BACK	VERT	---	C1

CONNECTION REQUIREMENTS

1: C1: A SUITABLE HANGER MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.0D/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (11.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.12')
ALLOWABLE DEFL.(TL) = L/360 (11.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.23')

CS: TC=0.53(1.00 (1-JT)), BC=0.79(1.00 (M-N)),
WB=0.97(1.00 (I-N)), SS=0.19(1.00 (L-M))
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1857 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (1) INPUT = 0.90 ;
JSI METAL = 0.91 (1) INPUT = 1.00 ;



Structural component only
DWG# T-2008057 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408317	T53	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 11:40:05 2020 Page 2
ID:DMCubINVR6TstFoe31v6I zns1I-Ai1Q7GbQ0IT?AuFYIGGxvz6OOQZMu0TFgRENSzLYme

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-I	MT20	5.0	6.0	2.50	2.25
C	TMWW-I	MT20	5.0	6.0		
D	TTWW-m	MT20	5.0	6.0	2.25	2.00
E	TTWW-m	MT20	5.0	6.0	2.25	2.00
F	TMWW-w	MT20	2.0	4.0		
G	TTWW-m	MT20	5.0	6.0	2.25	2.00
H	TMWW-I	MT20	5.0	6.0		
I	TMWW-I	MT20	5.0	6.0	2.50	2.25
J	TMWW-I	MT20	6.0	9.0	2.75	3.75
L	BMV1-I	MT20	7.0	8.0	Edge	1.50
M	BMWW-I	MT20	10.0	12.0		
N	BMWW-I	MT20	5.0	6.0	2.50	2.75
O	BMWW-I	MT20	5.0	6.0		
P	BS-I	MT20	5.0	6.0		
Q	BMWW-I	MT20	5.0	6.0		
R	BS-I	MT20	5.0	6.0		
S	BMWW-I	MT20	5.0	6.0		
T	BMWW-I	MT20	5.0	6.0	2.50	2.75
U	BMWW-I	MT20	10.0	12.0		
V	TMBMW1-p	MT20	7.0	12.0	9.75	3.50

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.


CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2008057 112

JOB NAME 408317	TRUSS NAME T54	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 8 Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:38 2020 Page 1	
ID:DMCubINVR6TstFoe31v6l_zns11-bX8072144nbkivQd7qV16pVhGb9vD8SXFkegSzLZV1				35-1-0	
1-3-8 0-0 4-3-13 4-3-13 4-1-5 8-5-3 4-1-5 12-6-8 8-8-15 19-3-7 6-8-15 26-0-6 4-5-1 30-5-7 31-7-8 33-8-4 35-1-0				Scale = 1/56.2	

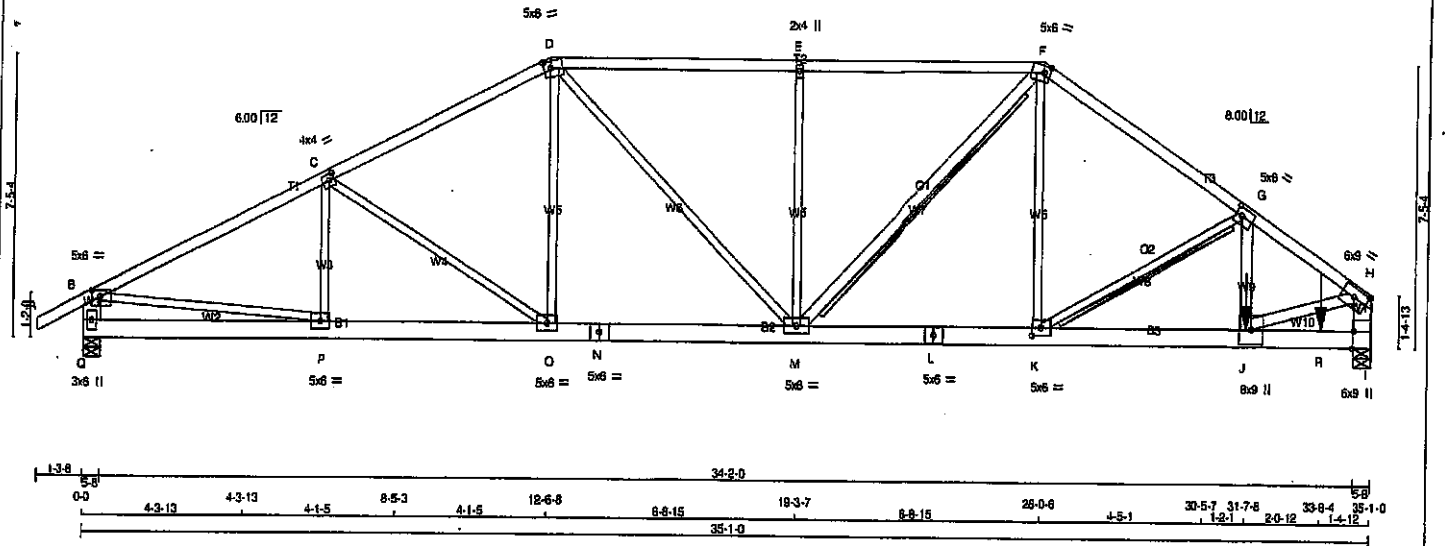

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
Q - B	2x6	DRY	No.2
I - H	2x6	DRY	No.2
Q - N	2x6	DRY	No.2
N - L	2x6	DRY	No.2
L - I	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
J - G	2x4	DRY	No.2
J - H	2x4	DRY	No.2
M - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-D 1	12	TOP
D-F 1	12	TOP
F-H 1	12	TOP
Q-B 2	12	TOP
I-H 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
Q-N 2	12	TOP
N-L 2	12	TOP
L-I 2	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	8	SIDE(137.1)
G-J 2	2	
2x4 1	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.



Structural component only
DWG# T-2008058 1/2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	HORZ	DOWN	HORZ
Q 2873	0	2873	0
I 7885	0	7885	0

UNFACTORED REACTIONS			
1ST LCASE	MAX/MIN	COMPONENT REACTIONS	
JT COMBINED	SNOW	LIVE	PERMALIVE
Q 1887	1255 / 0	0 / 0	0 / 0
I 5825	3738 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, I

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.91 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT G-K, F-M

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)
FR-TO			
A-B	0 / 28	-91.8 -91.8	0.07 (1)
B-C	-4025 / 0	-91.8 -91.8	0.51 (1)
C-D	-3735 / 0	-91.8 -91.8	0.46 (1)
D-E	-4129 / 0	-91.8 -91.8	0.56 (1)
E-F	-4129 / 0	-91.8 -91.8	0.58 (1)
F-G	-4951 / 0	-91.8 -91.8	0.40 (1)
G-H	-9200 / 0	-91.8 -91.8	0.47 (1)
Q-B	-2603 / 0	0.0 0.0	0.09 (1)
I-H	-7441 / 0	0.0 0.0	0.27 (1)
WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)
FR-TO			
P-C	-350 / 0	0.05 (1)	0.05 (1)
C-O	-377 / 0	0.20 (1)	0.20 (1)
O-D	0 / 383	0.04 (1)	0.04 (1)
K-F	0 / 2289	0.28 (1)	0.28 (1)
K-G	-4133 / 0	0.88 (1)	0.88 (1)
B-P	0 / 3852	0.45 (1)	0.45 (1)
J-G	0 / 3859	0.35 (1)	0.35 (1)
J-H	0 / 7993	0.71 (1)	0.71 (1)
M-F	-8 / 0	0.00 (4)	0.00 (4)
D-M	0 / 1175	0.15 (1)	0.15 (1)
M-E	-753 / 0	0.38 (1)	0.38 (1)
Q-P	0 / 0	-18.5 -18.5	0.05 (4)
P-O	0 / 3826	-18.5 -18.5	0.27 (1)
O-N	0 / 3316	-18.5 -18.5	0.25 (1)
N-M	0 / 3316	-18.5 -18.5	0.25 (1)
M-L	0 / 4132	-18.5 -18.5	0.31 (1)
L-K	0 / 4132	-18.5 -18.5	0.31 (1)
K-J	0 / 7680	-18.5 -18.5	0.81 (1)
J-R	0 / 0	-18.5 -18.5	0.28 (1)
R-I	0 / 0	-18.5 -18.5	0.28 (1)

FACTORED CONCENTRATED LOADS (LBS)			
JT	LOC.	LC1	MAX- MAX+
J	31-7-8	-5982	-5982
R	33-8-4	-884	-884

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. DL = 25.8 PSF
LL = 8.0 PSF
BOT CH. DL = 0.0 PSF
LL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/989 (0.10")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/989 (0.18")

CSI: TC=0.88/1.00 (D-E-I), BC=0.61/1.00 (J-K-I), WB=0.88/1.00 (G-K-I), SSI=0.71/1.00 (I-J-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (FL)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.88 (H) (INPUT = 0.90)
JSI METAL= 0.87 (J) (INPUT = 1.00)

JOB NAME 408317	TRUSS NAME T54	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------


Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:38 2020 Page 2
ID:DMCubINVR6TstFos31v6l zns1l-bX8072f44nbklvQd7gV18pVkgb9vD8ISXFkeqSzlZV1

PLATES (table is in inches)

J#	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	2.00	2.75
C	TMVW-l	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	6.0	2.25	2.00
E	TMVW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	8.0	2.25	2.00
G	TMVW-l	MT20	5.0	6.0	2.50	2.00
H	TMVW-l	MT20	6.0	9.0	2.75	4.50
I	BMV1-l	MT20	6.0	9.0	Edge	0.50
J	BMVW+l	MT20	8.0	9.0		
K	BMVW-l	MT20	5.0	8.0	2.50	2.75
L	BS-l	MT20	5.0	8.0		
M	BMVW+l	MT20	5.0	8.0		
N	BS-l	MT20	5.0	8.0		
O	BMVW-l	MT20	5.0	8.0		
P	BMVW-l	MT20	5.0	8.0		
Q	BMV1-p	MT20	3.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

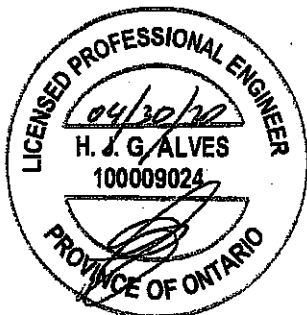


Structural component only
DWG# T-2008058 2/2

JOB NAME: 408317 TRUSS NAME: T55 QUANTITY: 1 PLY: 1 JOB DESC.: GREEN PARK HOMES TRUSS DESC.: Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 M/Tek Industries, Inc. Thu Apr 30 10:50:37 2020 Page 1
ID:DMCubINVR6TstF0e31v6l_zns11-3iOCQqir5jw2_pg00G020rD?Keyd4b1vTBCuzL_ZV0

Scale = 1:57.5

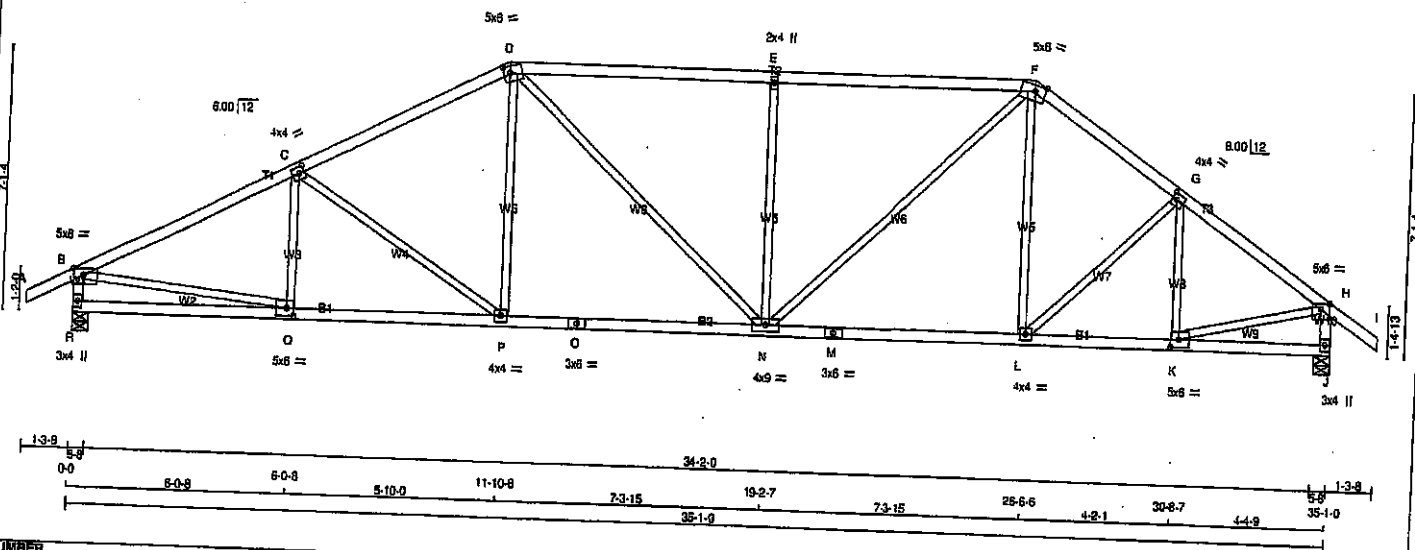

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2
H - B	2x4	DRY	No.2
B - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT
DRY: SEASONED LUMBER.

PLATES (Table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge 3.50
C	TMVW-l	MT20	4.0	4.0	2.00 1.75
D	TTWW-m	MT20	5.0	6.0	2.25 2.00
E	TMVW-w	MT20	2.0	4.0	
F	TTWW-m	MT20	5.0	8.0	2.00 3.25
G	TMVW-l	MT20	4.0	4.0	2.00 1.50
H	TMVW-p	MT20	5.0	8.0	1.75 3.00
J	BMV1+p	MT20	3.0	4.0	
K	BMVW-l	MT20	5.0	6.0	2.50 2.75
L	BMVW-l	MT20	4.0	4.0	
M	BS-l	MT20	3.0	6.0	
N	BMVW-w	MT20	4.0	9.0	
O	BS-l	MT20	3.0	6.0	
P	BMVW-l	MT20	4.0	4.0	
Q	BMVW-l	MT20	5.0	6.0	2.50 2.25
R	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
R	2059	0	2059	0	0/0	5-8
J	2060	0	2060	0	0/0	5-8

UNFACTORED REACTIONS

JT	1ST CASE COMBINED		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	SNOW	LIVE	PERM. LIVE	WIND			
R	1453	987/0	0/0	0/0	0/0	486/0	0/0
J	1454	988/0	0/0	0/0	0/0	487/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.34 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1		MAX. UNBRACED LENGTH	WEBS MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
		FROM	TO				
FR-TO							
A-B	0/28	-91.8	-91.8	0.12 (1)	10.00	0/0	0.07 (1)
B-C	-2880/0	-91.8	-91.8	0.58 (1)	3.58	-433/0	0.42 (1)
C-D	-2533/0	-91.8	-91.8	0.52 (1)	3.84	0/383	0.08 (1)
D-E	-2588/0	-91.8	-91.8	0.80 (1)	3.34	0/440	0.10 (1)
E-F	-2588/0	-91.8	-91.8	0.80 (1)	3.34	-828/0	0.72 (1)
F-G	-2250/0	-91.8	-91.8	0.27 (1)	4.33	0/977	0.22 (1)
G-H	-2262/0	-91.8	-91.8	0.27 (1)	4.32	0/169	0.05 (4)
H-I	0/35	-91.8	-91.8	0.12 (1)	10.00	-74/0	0.04 (1)
I-B	-2009/0	0.0	0.0	0.20 (1)	5.95	-401/0	0.11 (1)
J-H	-2021/0	0.0	0.0	0.21 (1)	5.94	0/2827	0.59 (1)
R-O	0/0	-18.5	-18.5	0.14 (4)	10.00	0/1959	0.44 (1)
O-P	0/2800	-18.5	-18.5	0.51 (1)	10.00		
P-O	0/2244	-18.5	-18.5	0.48 (1)	10.00		
O-N	0/2244	-18.5	-18.5	0.46 (1)	10.00		
N-M	0/1650	-18.5	-18.5	0.40 (1)	10.00		
M-L	0/1650	-18.5	-18.5	0.40 (1)	10.00		
L-K	0/1502	-18.5	-18.5	0.39 (1)	10.00		
K-J	0/0	-18.5	-18.5	0.08 (4)	10.00		

TOTAL WEIGHT = 145 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TBC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/999 (0.14")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/999 (0.28")

CSI: TC=0.80/1.00 (D-E-1), BC=0.51/1.00 (P-Q-1), WB=0.72/1.00 (E-N-1), SS=0.33/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1887 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (H) (INPUT = 0.90)
JSI METAL = 0.70 (C) (INPUT = 1.00)



Structural component only
DWG# T-2008059

JOB NAME 408317	TRUSS NAME T56	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:33 2020 Page 1					
ID:DMCubINVR6TstFoe3rv6f_zns11-06p8d4lyNizJ9M8C0p2kkR7C0oBdQTpuDDyHnzLZV					
Scale = 1:57.8					

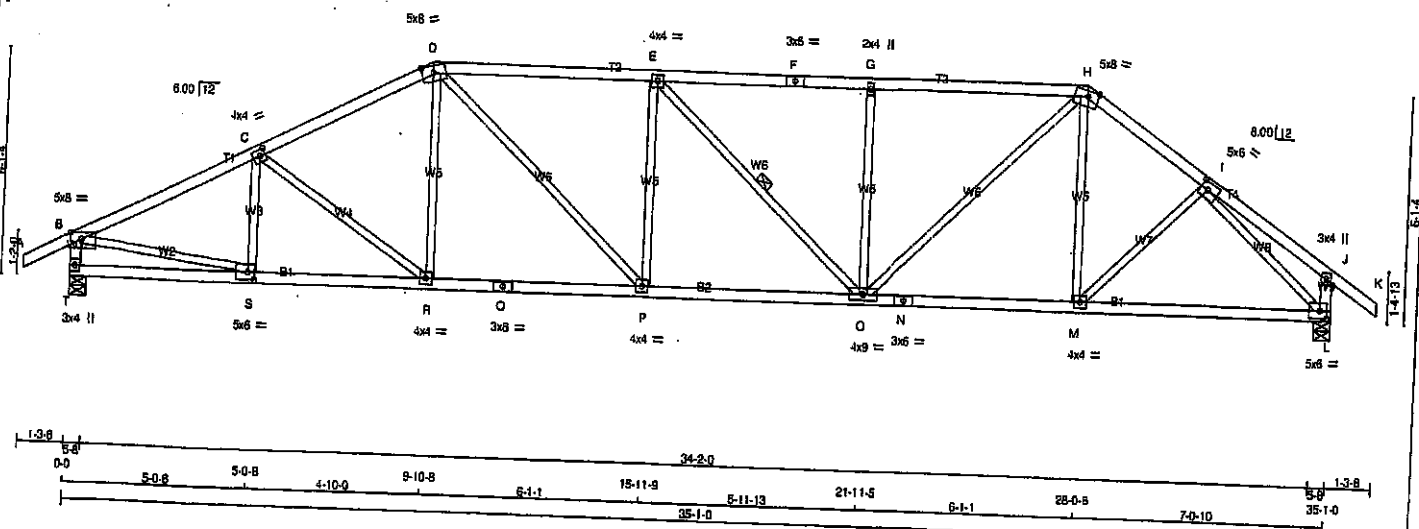

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	LUMBER
A - D	2x4	DRY No.2
D - F	2x4	DRY No.2
F - H	2x4	DRY No.2
H - K	2x4	DRY No.2
T - B	2x4	DRY No.2
L - J	2x4	DRY No.2
T - Q	2x4	DRY No.2
Q - N	2x4	DRY No.2
N - L	2x4	DRY No.2

ALL WEBS 2x3 DRY No.2

EXCEPT

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMWW-p	MT20	5.0	8.0	Edge	3.50
C TMWW-l	MT20	4.0	4.0	2.00	1.75
D TTWW-m	MT20	5.0	8.0	2.25	3.75
E TMWW-l	MT20	4.0	4.0		
F TS-l	MT20	3.0	4.0		
G TMW-w	MT20	2.0	4.0		
H TTWW-m	MT20	5.0	8.0	1.75	3.50
I TMWW-l	MT20	5.0	8.0	2.50	2.50
J TMV-p	MT20	3.0	4.0		
L BMVW-l	MT20	5.0	8.0	2.50	2.25
M, P, R					
M BMWW-l	MT20	4.0	4.0		
N BS-l	MT20	3.0	6.0		
O BMWW-l	MT20	4.0	9.0		
Q BS-l	MT20	3.0	6.0		
S BMWW-l	MT20	5.0	6.0	2.50	2.00
T BMV-l-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT 2059	DOWN 2059	0	5-8
T	HORZ 0	UP/LIFT 0	0	5-8
L	0	0	0	5-8

UNFACTORED REACTIONS

	1ST LOASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED SNOW	LIVE PERM. LIVE WIND DEAD SOIL
T	1453	987 / 0 0 / 0 0 / 0 496 / 0 0 / 0
L	1454	988 / 0 0 / 0 0 / 0 497 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.39 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO				FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	S-C	-348 / 0	0.08 (1)	
B-C	-2828 / 0	-91.8	-91.8 0.54 (1)	C-R	-218 / 0	0.14 (1)	
C-D	-2674 / 0	-91.8	-91.8 0.51 (1)	R-D	0 / 231	0.05 (1)	
D-E	-2958 / 0	-91.8	-91.8 0.72 (1)	D-P	0 / 808	0.18 (1)	
E-F	-2795 / 0	-91.8	-91.8 0.68 (1)	P-E	-444 / 0	0.26 (1)	
F-G	-2795 / 0	-91.8	-91.8 0.68 (1)	E-O	-228 / 0	0.11 (1)	
G-H	-2795 / 0	-91.8	-91.8 0.68 (1)	O-G	-589 / 0	0.35 (1)	
H-I	-2299 / 0	-91.8	-91.8 0.23 (1)	O-H	0 / 1243	0.28 (1)	
I-J	0 / 18	-91.8	-91.8 0.18 (1)	M-H	0 / 95	0.03 (4)	
J-K	0 / 35	-91.8	-91.8 0.12 (1)	M-I	0 / 134	0.03 (4)	
T-B	-2015 / 0	0.0	0.0 0.20 (1)	B-S	0 / 2586	0.58 (1)	
L-J	-255 / 0	0.0	0.0 0.03 (1)	I-L	-2508 / 0	0.96 (1)	
T-S	0 / 0	-18.5	-18.5 0.10 (4)				
S-R	0 / 2549	-18.5	-18.5 0.48 (1)				
R-Q	0 / 2374	-18.5	-18.5 0.45 (1)				
Q-P	0 / 2374	-18.5	-18.5 0.45 (1)				
P-O	0 / 2959	-18.5	-18.5 0.54 (1)				
O-N	0 / 1895	-18.5	-18.5 0.42 (1)				
N-M	0 / 1895	-18.5	-18.5 0.42 (1)				
M-L	0 / 1797	-18.5	-18.5 0.40 (1)				

TOTAL WEIGHT = 145 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(95 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")

CALCULATED VERT. DEFL.(LL) = L/999 (0.16")

ALLOWABLE DEFL.(TL) = L/360 (1.17")

CALCULATED VERT. DEFL.(TL) = L/999 (0.31")

CSL TO=0.72/1.00 (D-E-1), BC=0.54/1.00 (O-P-1), WB=0.96/1.00 (I-L-1), SS=0.28/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES


PLATE GRIP(DRY) SHEAR (PSI)	SECTION (PL)	MAX MIN MAX MIN MAX MIN
MT20	618 354 1667 789 1987 1658	

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.90 (L) (INPUT = 0.90)

JSI METAL= 0.74 (Q) (INPUT = 1.00)

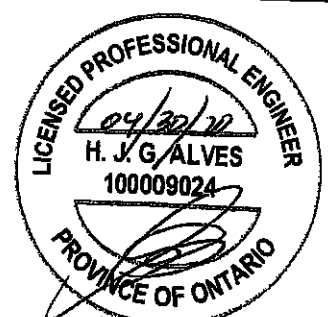

Structural component only
DWG# T-2008060

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408317	T57	1	1	TRUSS DESC.		


Tanarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Thu Apr 30 10:50:40 2020 Page 1

ID:DMCub1NVR6TstFoe31v6l_zns11-UINXqQla805AnWjCMWazHfgO_CWu9zF2SiroDzLZUz

1-3-8 0-0 4-0-8 4-0-8 3-10-0 7-10-8 5-5-9 13-4-1 5-4-5 18-8-7 5-4-5 24-0-12 5-5-9 28-6-6 35-1-0 35-4-8 1-3-8

Scale = 1:57.5

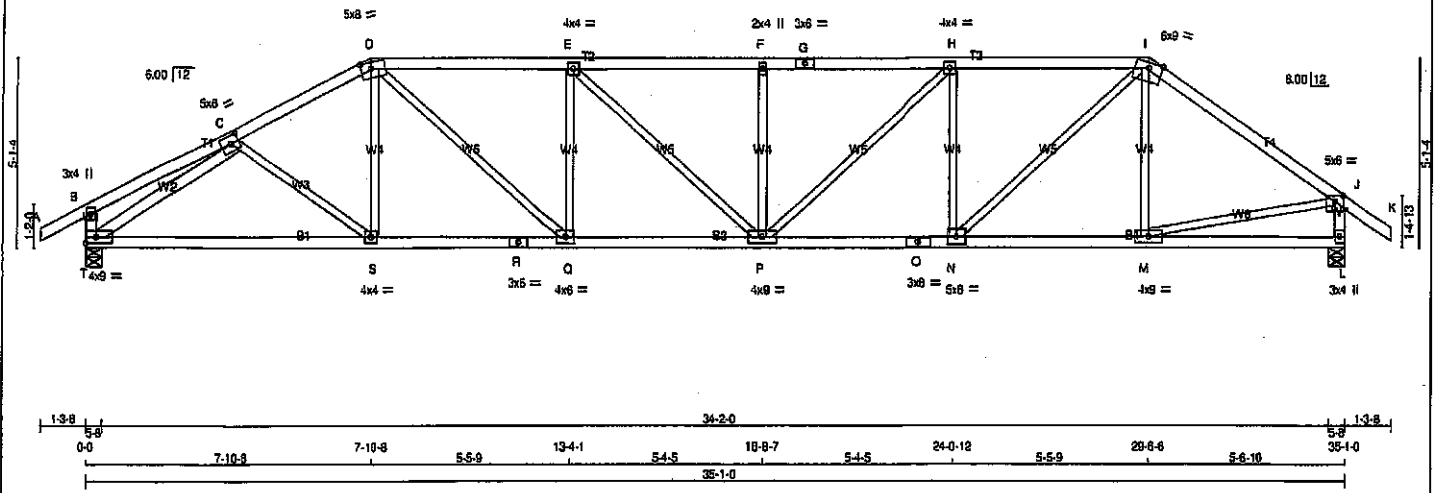

LUMBER				N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF			
D - G	2x4	DRY	No.2	SPF			
G - I	2x4	DRY	No.2	SPF			
I - K	2x4	DRY	No.2	SPF			
T - B	2x4	DRY	No.2	SPF			
L - J	2x4	DRY	No.2	SPF			
T - R	2x4	DRY	No.2	SPF			
R - O	2x4	DRY	No.2	SPF			
O - L	2x4	DRY	No.2	SPF			
ALL WEBS	2x3	DRY	No.2	SPF			
EXCEPT							
T - C	2x4	DRY	No.2	SPF			

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
C	TMVW-1	MT20	5.0	8.0	2.50 2.75
D	TTWV-m	MT20	5.0	8.0	2.00 3.25
E	TMVW-1	MT20	4.0	4.0	
F	TMVW-w	MT20	2.0	4.0	
G	TS-1	MT20	3.0	8.0	
H	TMVW-1	MT20	4.0	4.0	
I	TTWV-m	MT20	6.0	9.0	Edge
J	TMVW-p	MT20	5.0	8.0	1.75 3.00
L	BMV1+p	MT20	3.0	4.0	
M	BMVW-1	MT20	4.0	9.0	
N	BMVW-1	MT20	5.0	6.0	
O	BS-1	MT20	3.0	6.0	
P	BMVW-1	MT20	4.0	9.0	
Q	BMVW-1	MT20	4.0	6.0	
R	BS-1	MT20	3.0	6.0	
S	BMVW-1	MT20	4.0	4.0	
T	BMVW-1	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
		GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
T	2059	0	2059	0	0	5-8	5-8	5-8	5-8
L	2060	0	2060	0	0	5-8	5-8	5-8	5-8
UNFACTORED REACTIONS									
		1ST CASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
T	1453	967 / 0	0 / 0	0 / 0	0 / 0	486 / 0	0 / 0		
L	1454	968 / 0	0 / 0	0 / 0	0 / 0	487 / 0	0 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.18 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS						WEBS					
MAX. FACTORED		FACTORED		MAX. FACTORED		MAX. FACTORED		MAX. FACTORED		MAX. FACTORED	
MEMB.	FORCE	VERT. LOAD	LC1	MAX	UNBRAC	MEMB.	FORCE	VERT. LOAD	LC1	MAX	UNBRAC
	(LBS)	(PLF)	CS1 (LC)				(LBS)		CS1 (LC)		
FR-TO		FROM	TO	LENGTH	FR-TO			FROM	TO	LENGTH	FR-TO
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	C-S	0 / 92	0.03 (4)			
B-C	0 / 16	-91.8	-91.8	0.20 (1)	10.00	S-D	0 / 117	0.04 (4)			
C-D	-2790 / 0	-91.8	-91.8	0.31 (1)	3.89	D-Q	0 / 1201	0.27 (1)			
D-E	-3383 / 0	-91.8	-91.8	0.65 (1)	3.26	Q-E	-712 / 0	0.27 (1)			
E-F	-3551 / 0	-91.8	-91.8	0.67 (1)	3.16	P-F	0 / 228	0.05 (1)			
F-G	-3551 / 0	-91.8	-91.8	0.67 (1)	3.16	P-H	-454 / 0	0.17 (1)			
G-H	-3551 / 0	-91.8	-91.8	0.67 (1)	3.16	P-H	0 / 607	0.14 (1)			
H-I	-3100 / 0	-91.8	-91.8	0.61 (1)	3.42	N-H	-963 / 0	0.37 (1)			
I-J	-2289 / 0	-91.8	-91.8	0.70 (1)	3.79	N-I	0 / 1601	0.36 (1)			
J-K	0 / 35	-91.8	-91.8	0.12 (1)	10.00	M-I	-247 / 5	0.09 (1)			
T-B	-270 / 0	0.0	0.0	0.03 (1)	7.81	T-C	-2965 / 0	0.82 (1)			
L-J	-2017 / 0	0.0	0.0	0.21 (1)	5.94	M-J	0 / 1936	0.44 (1)			
T-S	0 / 2410	-18.5	-18.5	0.53 (1)	10.00						
S-R	0 / 2480	-18.5	-18.5	0.53 (1)	10.00						
R-Q	0 / 2480	-18.5	-18.5	0.53 (1)	10.00						
Q-P	0 / 3383	-18.5	-18.5	0.60 (1)	10.00						
P-O	0 / 3100	-18.5	-18.5	0.55 (1)	10.00						
O-N	0 / 3100	-18.5	-18.5	0.55 (1)	10.00						
N-M	0 / 1897	-18.5	-18.5	0.38 (1)	10.00						
M-L	0 / 0	-18.5	-18.5	0.14 (4)	10.00						

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CS1 TO=0.70/1.00 (T-H), BC=0.60/1.00 (P-Q), WS=0.82/1.00 (C-T), SS=0.23/1.00 (H-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP = 0.90 (J) (INPUT = 0.90)
JSI METAL = 0.90 (Q) (INPUT = 1.00)



Structural component only
DWG# T-2008061

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408317	T58	1	1	GREEN PARK HOMES	

Version 8.310 S Oct 29 2019 MTak Industries, Inc. Thu Apr 30 10:50:41 2020 Page 1
 ID:DMCubINVR8TsF0e31v6l_zns1l-yVxv2mDVKD1PgIbVE5CpsCoxCs?uJd8gRPKtZLZuy
 Scale = 1:50.9

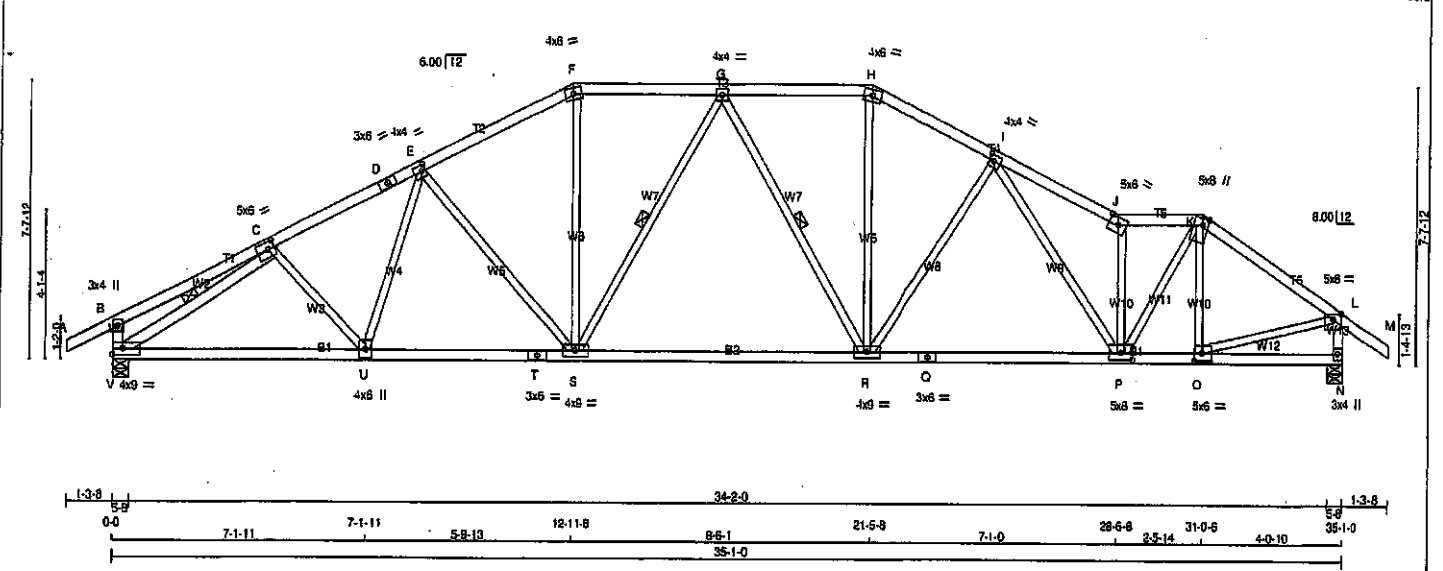

TOTAL WEIGHT = 155 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	SPF	BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD	SPECIFIED LOADS:
A - D	2x4	DRY	No.2	SPF			GROSS REACTION	GROSS REACTION	BRG	BRG	TOP CH. LL = 25.6 PSF
D - F	2x4	DRY	No.2	SPF			VERT	DOWN	IN-SX	IN-SX	DL = 6.0 PSF
F - H	2x4	DRY	No.2	SPF			0	0	5-8	5-8	BOT CH. LL = 0.0 PSF
H - J	2x4	DRY	No.2	SPF			2059	2059	0	0	DL = 7.4 PSF
J - K	2x4	DRY	No.2	SPF			0	0	5-8	5-8	TOTAL LOAD = 39.0 PSF
K - M	2x4	DRY	No.2	SPF			2060	2060	0	0	
M - N	2x4	DRY	No.2	SPF							SPACING = 24.0 IN. C/C
N - L	2x4	DRY	No.2	SPF							
L - T	2x4	DRY	No.2	SPF							
T - Q	2x4	DRY	No.2	SPF							
Q - N	2x4	DRY	No.2	SPF							
ALL WEBS	2x3	DRY	No.2	SPF							
EXCEPT											
V - C	2x4	DRY	No.2	SPF							

DRY: SEASONED LUMBER.

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.67 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-S, G-R, C-V.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
 TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	FACTORED (PLF)	MAX. FACTORED (CSI (LC))	MEMB.	FORCE (LBS)	FACTORED (PLF)	MAX. FACTORED (CSI (LC))
FR-TO		FROM TO	LENGTH	FR-TO		FROM TO	LENGTH
A-B	0/28	-91.8	-91.8 0.13 (1)	10.00	C-U	0/77	0.03 (4)
B-C	0/15	-91.8	-91.8 0.23 (1)	10.00	U-E	0/85	0.04 (4)
C-D	-2780/0	-91.8	-91.8 0.39 (1)	3.78	E-S	-474/0	0.42 (1)
D-E	-2780/0	-91.8	-91.8 0.39 (1)	3.78	S-F	0/789	0.19 (1)
E-F	-2429/0	-91.8	-91.8 0.36 (1)	4.04	S-G	-317/0	0.18 (1)
F-G	-2187/0	-91.8	-91.8 0.37 (1)	4.21	G-R	-222/0	0.11 (1)
G-H	-2213/0	-91.8	-91.8 0.37 (1)	4.16	R-H	0/626	0.20 (1)
H-I	-2481/0	-91.8	-91.8 0.30 (1)	4.05	R-I	-563/0	0.47 (1)
I-J	-3018/0	-91.8	-91.8 0.35 (1)	3.67	I-P	0/378	0.09 (1)
J-K	-2874/0	-91.8	-91.8 0.20 (1)	4.03	P-J	-1585/0	0.43 (1)
K-L	-2219/0	-91.8	-91.8 0.39 (1)	4.15	V-C	-2991/0	0.50 (1)
L-M	0/35	-91.8	-91.8 0.14 (1)	10.00	O-K	-411/0	0.11 (1)
V-B	-291/0	0.0	0.0 0.03 (1)	7.81	P-K	0/1583	0.39 (1)
N-L	-2027/0	0.0	0.0 0.23 (1)	5.88	O-L	0/1904	0.47 (1)

Edge - INDICATES REFERENCE CORNER OF PLATE TOUGHES EDGE OF CHORD.

ALLOWABLE DEFL.(LL) = L/380 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.31")

CS1: TC=0.39/1.00 (C-E:1), BC=0.61/1.00 (P-R:1), WB=0.50/1.00 (C-V:1), SS=0.21/1.00 (F-G:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 786 1987 1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (K) (INPUT = 0.80)
 JSI METAL= 0.75 (T) (INPUT = 1.00)

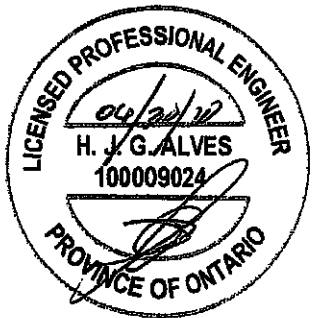


Structural component only
 DWG# T-2008062

DRWG NO.	
----------	--

1-3-8 0-0 5-10-8 11-7-2 13-6-8 15-5-12 15-8-8 17-2-8 17-5-12 18-6-8 20-10-8 20-9-4 28-6-8 34-5-0 35-8-8
13-8 5-10-8 11-11-5 11-11-4 2-12 1-8-0 3-4-1 2-12 2-2-0 1-11-6 5-8-10 13-8

Scale = 1:56

[illegible]

DRY: SEASONED LUMBER.

LOAD(PLF)

TOP
TOP
SIDE(0.0)
TOP
TOP
TOP

TOP
SIDE(163.1)
TOP

SIDE(237.3)

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY

Structural component only
DWG# T-2008063 *42*

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

UNFACTORED REACTIONS							
JT	1ST CASE	MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
T	2885	1951 / 0	0 / 0	0 / 0	0 / 0	933 / 0	0 / 0
K	2772	1872 / 0	0 / 0	0 / 0	0 / 0	900 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T. K.

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.22 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBB				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX FACTORED CSI (LC)	
FR-TO		FROM TO			FR-TO			
A-B	0 / 28	-91.8	-91.8	0.07 (1)	10.00	S-C	-588 / 0	0.07 (1)
B-C	-6510 / 0	-91.8	-91.8	0.64 (1)	3.38	L-H	-577 / 0	0.07 (1)
C-D	-11895 / 0	-91.8	-91.8	0.54 (1)	3.22	B-S	0 / 5888	0.73 (1)
D-E	-12303 / 0	-91.8	-91.8	0.34 (1)	3.31	L-I	0 / -5821	0.70 (1)
E-U	-2303 / 0	-91.8	-91.8	0.34 (1)	3.31	P-S	-392 / 0	0.05 (1)
F-F	-2488 / 0	-91.8	-91.8	0.33 (1)	3.30	E-O	0 / 60	0.01 (1)
F-G	-2488 / 0	-91.8	-91.8	0.33 (1)	3.30	C-D	-1367 / 0	0.18 (1)
G-H	-11395 / 0	-91.8	-91.8	0.51 (1)	3.31	N-G	-2829 / 0	0.31 (1)
H-I	-6215 / 0	-91.8	-91.8	0.82 (1)	3.47	D-P	0 / 706	0.09 (1)
I-J	0 / 28	-91.8	-91.8	0.07 (1)	10.00	C-G	0 / 2219	0.27 (1)
T-B	-4062 / 0	0.0	0.0	0.14 (1)	7.08	C-Q	0 / 6770	0.84 (1)
K-I	-3996 / 0	0.0	0.0	0.14 (1)	7.17	N-H	0 / 6441	0.80 (1)
T-S	0 / 0	-18.5	-18.5	0.08 (4)	10.00			
S-R	0 / 5853	-18.5	-18.5	0.48 (1)	10.00			
R-Q	0 / 5853	-18.5	-18.5	0.48 (1)	10.00			
Q-P	0 / 11956	-18.5	-18.5	0.87 (1)	10.00			
P-V	0 / 12462	-18.5	-18.5	0.93 (1)	10.00			
V-O	0 / 12462	-18.5	-18.5	0.93 (1)	10.00			
O-N	0 / 11395	-18.5	-18.5	0.86 (1)	10.00			
N-M	0 / 5588	-18.5	-18.5	0.43 (1)	10.00			
M-L	0 / 5588	-18.5	-18.5	0.43 (1)	10.00			
L-K	0 / 0	-18.5	-18.5	0.06 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	17-5-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
O	18-8-8	-2098	-2098	---	BACK	VERT	TOTAL	---	C1
P	15-5-12	-26	-25	---	BACK	VERT	TOTAL	---	C1
Q	13-6-8	-1611	-1611	---	BACK	VERT	TOTAL	---	C1
U	15-6-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	17-5-12	-26	-26	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP	CH.	LL	=	25.6	PSF
		DL	=	6.0	PSF
BOT	CH.	LL	=	0.0	PSF
		DL	=	7.4	PSF
TOTAL LOAD				=	39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.15")
 CALCULATED VERT. DEFL.(LL) = $L/999$ (0.34")
 ALLOWABLE DEFL.(TL) = $L/380$ (1.15")
 CALCULATED VERT. DEFL.(TL) = $L/871$ (0.62")

CSI: TC=0.64/1.00 (B-C:1), BC=0.93/1.00 (O-P:1),
WR=0.84/1.00 (C-D:1), SSI=0.13/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)		SHEAR		SECTION
	(PSI)		(PLI)		(PLI)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	618	354	1667	788	1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (N) (INPUT = 0.90)
JSI METAL= 0.60 (R) (INPUT = 1.00)


CONTINUED ON PAGE 2

JOB NAME 408317	TRUSS NAME T59	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:43 2020 Page 2
ID:DMCubINVR8TatFoe31v6I zns11-ut3ITSITRxTiezSz17quHlu8QTSMinU8rwWPYzLZUw

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-p	MT20	4.0	9.0	1.00	4.75
C	TTWW+m	MT20	7.0	8.0	2.75	2.50
D, E, G						
D	TMWW-t	MT20	5.0	6.0		
F	TS-t	MT20	5.0	6.0		
H	TTWW+m	MT20	7.0	8.0	2.75	2.50
I	TMWW-p	MT20	4.0	9.0	1.00	4.75
K	BMV1-p	MT20	3.0	6.0		
L	BMWW-t	MT20	5.0	8.0	2.50	3.75
M	BS-t	MT20	5.0	6.0		
N	BMWW-t	MT20	5.0	8.0	2.50	2.75
O	BMWW-t	MT20	5.0	6.0		
P	BMWW-t	MT20	5.0	6.0		
Q	BMWW-t	MT20	5.0	8.0	2.50	2.75
R	BS-t	MT20	5.0	6.0		
S	BMWW-t	MT20	5.0	8.0	2.50	3.75
T	BMV1-p	MT20	3.0	6.0		

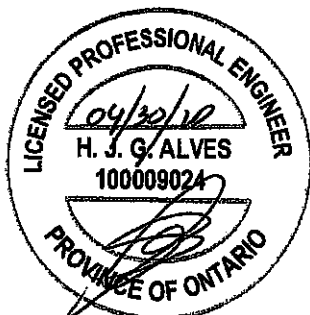


Structural component only
DWG# T-2008063

JOB NAME 408317	TRUSS NAME T60X	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	---------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:50:44 2020 Page 1
ID:DMCubINVR8TstFoe31v8l_zns1l-M4d1gum5CFbcG71AbMevRVq0bptP5jzdmVg3x_zLZUv

1-3-8 0-0 3-8-8 3-8-8 1-2-0 7-10-8 6-3-1 14-1-9 6-1-13 20-3-7 6-3-1 25-6-8 4-2-0 30-8-5 4-4-8 35-1-0
Scale = 1:56.4

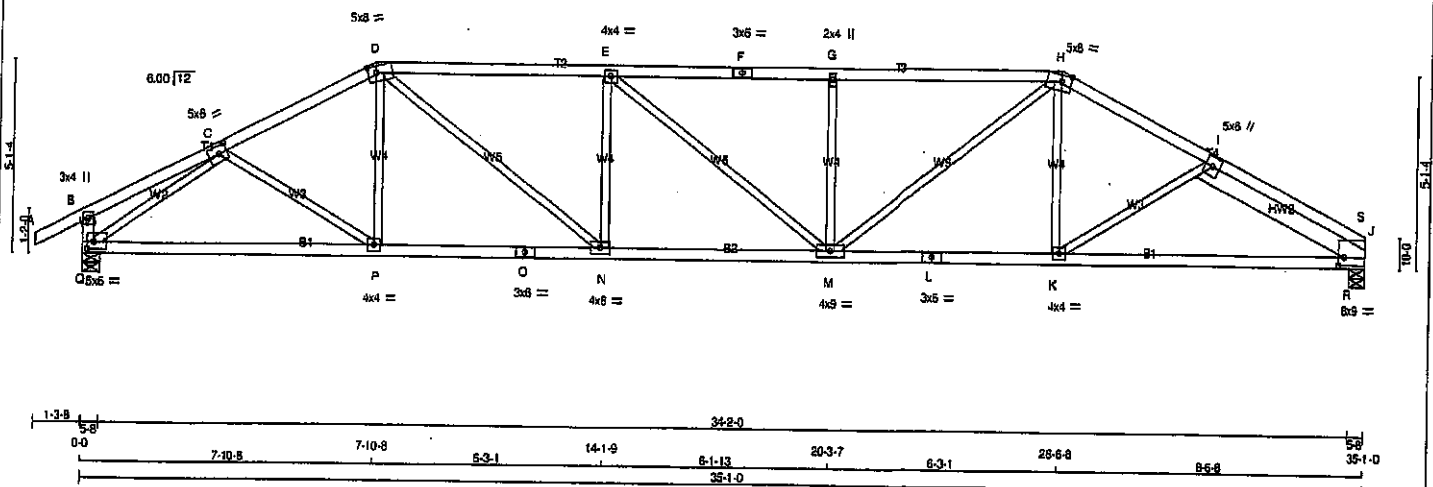

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4 DRY	No.2		
D - F	2x4 DRY	No.2		
F - H	2x4 DRY	No.2		
H - J	2x4 DRY	No.2		
J - L	2x4 DRY	No.2		
L - S	2x4 DRY	No.2		

REINFORCING MEMBERS	SIZE	LUMBER
HW2	2x6 DRY	No.2
ALL WEBS EXCEPT	2x3 DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)	TYPE	PLATES	W	LEN	Y	X
JT	TMV-p	MT20	3.0	4.0		
B	TMVW-i	MT20	5.0	6.0	2.50	2.75
C	TTWW-m	MT20	5.0	8.0	2.25	2.75
D	TMVW-i	MT20	4.0	4.0		
E	TS-i	MT20	3.0	6.0		
F	TMVW-i	MT20	2.0	4.0		
G	TTWW-m	MT20	5.0	8.0	2.25	3.25
H	TMVW-i	MT20	5.0	6.0		
I	TMVW-i	MT20	8.0	9.0	2.50	2.00
J	BMVW-i	MT20	4.0	4.0		
K	BS-i	MT20	3.0	6.0		
L	BMVW-i	MT20	4.0	9.0		
M	BMVW-i	MT20	4.0	6.0		
N	BS-i	MT20	3.0	6.0		
O	BMVW-i	MT20	4.0	4.0		
P	BS-i	MT20	5.0	6.0	2.25	2.00
Q	BMVW-i	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	0	0
J	1934	0	1934	0
Q	2059	0	2059	0

UNFACTORED REACTIONS	1ST CASE	MAX/MIN COMPONENT REACTIONS
	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
JT	1368	898 / 0 0 / 0 0 / 0 470 - 0 0 / 0
J	1453	987 / 0 0 / 0 0 / 0 488 - 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, Q

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.02 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS					
MEMB.	MAX. FACTORED	FORCE (LBS)	VERT. LOAD	LC1	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED	FORCE (LBS)	MAX. UNBRACED LENGTH
FR-TO			FROM	TO	CSI (LC)	FR-TO			CSI (LC)
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	C-P	0 / 130	0.04 (4)	
B-C	0 / 17	-91.8	-91.8	0.19 (1)	10.00	P-D	0 / 116	0.04 (4)	
C-D	-2789 / 0	-91.8	-91.8	0.32 (1)	3.89	D-N	0 / 1246	0.28 (1)	
D-E	-3468 / 0	-91.8	-91.8	0.85 (1)	3.05	E-M	-655 / 0	0.25 (1)	
E-F	-3515 / 0	-91.8	-91.8	0.85 (1)	3.02	M-H	0 / 59	0.01 (1)	
F-G	-3515 / 0	-91.8	-91.8	0.85 (1)	3.02	M-G	-617 / 0	0.24 (1)	
G-H	-3515 / 0	-91.8	-91.8	0.85 (1)	3.03	H-K	0 / 1128	0.25 (1)	
H-I	-2942 / 0	-91.8	-91.8	0.33 (1)	3.80	K-I	0 / 231	0.06 (4)	
I-S	-1483 / 0	-91.8	-91.8	0.23 (1)	5.13	K-I	-164 / 0	0.07 (1)	
S-J	-2458 / 0	-91.8	-91.8	0.16 (1)	4.25	Q-C	-2942 / 0	0.97 (1)	
Q-B	-252 / 0	0.0	0.0	0.03 (1)	7.81	R-S	0 / 1217	0.00 (1)	
						R-I	-1727 / 0	0.34 (1)	
Q-P	0 / 2368	-18.5	-18.5	0.52 (1)	10.00				
P-O	0 / 2481	-18.5	-18.5	0.53 (1)	10.00				
O-N	0 / 2481	-18.5	-18.5	0.53 (1)	10.00				
N-M	0 / 3469	-18.5	-18.5	0.83 (1)	10.00				
M-L	0 / 2821	-18.5	-18.5	0.54 (1)	10.00				
L-K	0 / 2821	-18.5	-18.5	0.54 (1)	10.00				
K-R	0 / 2754	-18.5	-18.5	0.56 (1)	10.00				
R-J	0 / 1333	-18.5	-18.5	0.35 (4)	10.00				

TOTAL WEIGHT = 139 lb (N)

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(35% OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/989 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/989 (0.40")

CSI: TC=0.85/1.00 (G-H:1), BC=0.63/1.00 (M-N:1), WB=0.97/1.00 (C-Q:1), SS=0.28/1.00 (J-R:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1655

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (H) (INPUT = 0.90)
JSI METAL = 0.81 (L) (INPUT = 1.00)

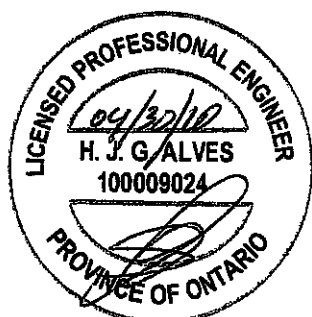

Structural component only
DWG# T-2008064

JOB NAME 408317	TRUSS NAME T61X	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:50:45 2020 Page 1	
ID:DMCubINVR6TstFoe31v6l_zns1l-qGBQu7mizYTuHcm8398_iNBBD88qGHnb9PcTQzLZUu				Scale = 1:58.5	

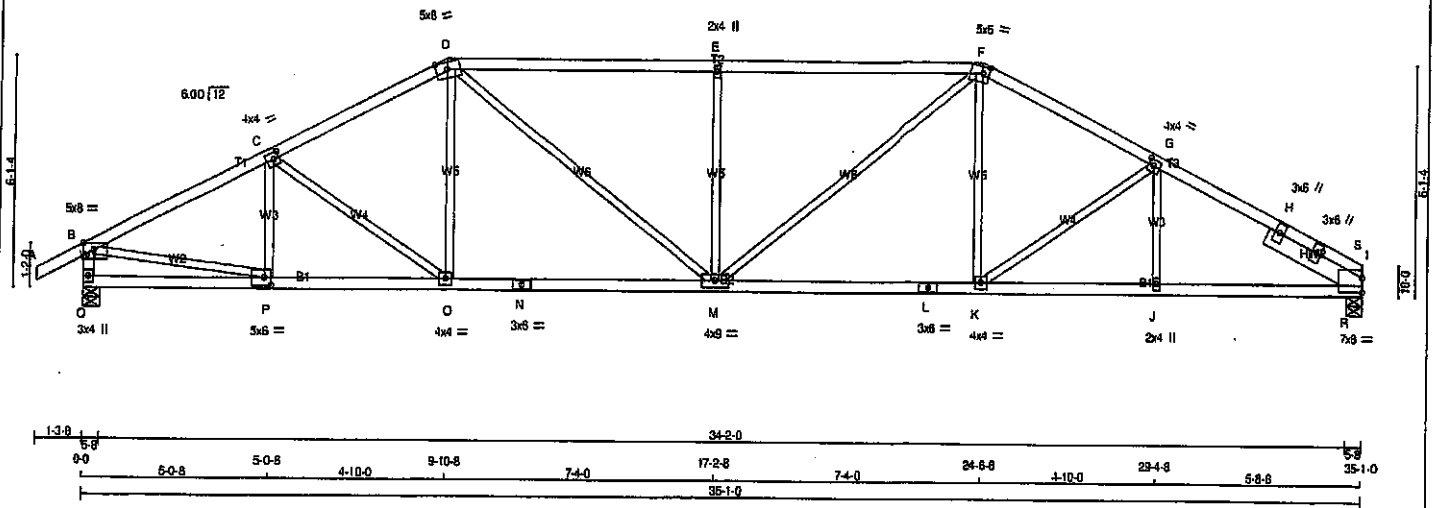

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
O - B	2x4	DRY	No.2
O - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
L - I	2x4	DRY	No.2
REINFORCING MEMBERS			
HW2	2x6	DRY	No.2
ALL WEBS 2x3 DRY EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	8.0	Edge 3.50
C	TMVW-t	MT20	4.0	4.0	2.00 1.75
D	TTWW-m	MT20	5.0	8.0	2.25 3.75
E	TMVW-w	MT20	2.0	4.0	
F	TTWW-m	MT20	5.0	8.0	2.25 2.00
G	TMVW-t	MT20	4.0	4.0	2.00 1.75
I	TMBMR-t	MT20	7.0	8.0	4.50
I	RT-t	MT20	3.0	6.0	
I	RT-t	MT20	3.0	6.0	
J	BMVW-w	MT20	2.0	4.0	
K	BMVW-t	MT20	4.0	4.0	
L	BS-t	MT20	3.0	6.0	
M	BMVWW-t	MT20	4.0	9.0	
N	BS-t	MT20	3.0	6.0	
O	BMVW-t	MT20	4.0	4.0	
P	BMVW-t	MT20	5.0	8.0	2.50 2.00
Q	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	
I	1934 0	1934 0	0	5-8	5-8
Q	2059 0	2059 0	0	5-8	5-8

UNFACTORED REACTIONS					
JT	1ST LOSE COMBINED	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE
I	1388	888 / 0	0 / 0	0 / 0	0 / 0
Q	1453	987 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I, Q

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.03 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS					
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LOAD LC1 (LC)	MAX. UNBRACED LENGTH (FR-TO)	MEMB.
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	P-C
B-C	-2827 / 0	-91.8	-91.8 0.39 (1)	3.81	C-O
C-D	-2878 / 0	-91.8	-91.8 0.37 (1)	3.92	O-D
D-E	-3031 / 0	-91.8	-91.8 0.86 (1)	3.03	D-M
E-F	-3031 / 0	-91.8	-91.8 0.86 (1)	3.03	M-E
F-G	-2763 / 0	-91.8	-91.8 0.45 (1)	3.77	M-F
G-H	-2210 / 0	-91.8	-91.8 0.53 (1)	4.02	K-F
H-S	-2210 / 0	-91.8	-91.8 0.53 (1)	4.02	K-G
S-I	-2714 / 0	-91.8	-91.8 0.17 (1)	4.09	J-G
Q-B	-2014 / 0	0.0	0.0 0.20 (1)	5.95	B-P
Q-P	0 / 0	-18.5	-18.5 0.10 (4)	10.00	R-S
P-O	0 / 2548	-18.5	-18.5 0.50 (1)	10.00	R-H
O-N	0 / 2377	-18.5	-18.5 0.47 (1)	10.00	
N-M	0 / 2377	-18.5	-18.5 0.47 (1)	10.00	
M-L	0 / 2472	-18.5	-18.5 0.51 (1)	10.00	
L-K	0 / 2472	-18.5	-18.5 0.51 (1)	10.00	
K-J	0 / 2727	-18.5	-18.5 0.55 (1)	10.00	
J-I	0 / 2727	-18.5	-18.5 0.73 (1)	10.00	
R-I	0 / 1301	-18.5	-18.5 0.50 (1)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.9 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (1.17")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.18")
ALLOWABLE DEFL. (TL) = $L/360$ (1.17")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.35")

CSI: TO=0.86/1.00 (D-E:1), BC=0.73/1.00 (J-R:1), WB=0.58/1.00 (B-P:1), SS=0.37/1.00 (I-R:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.89 (F) (INPUT = 0.90)
JSI METAL=0.98 (I) (INPUT = 1.00)



Structural component only
DWG# T-2008065

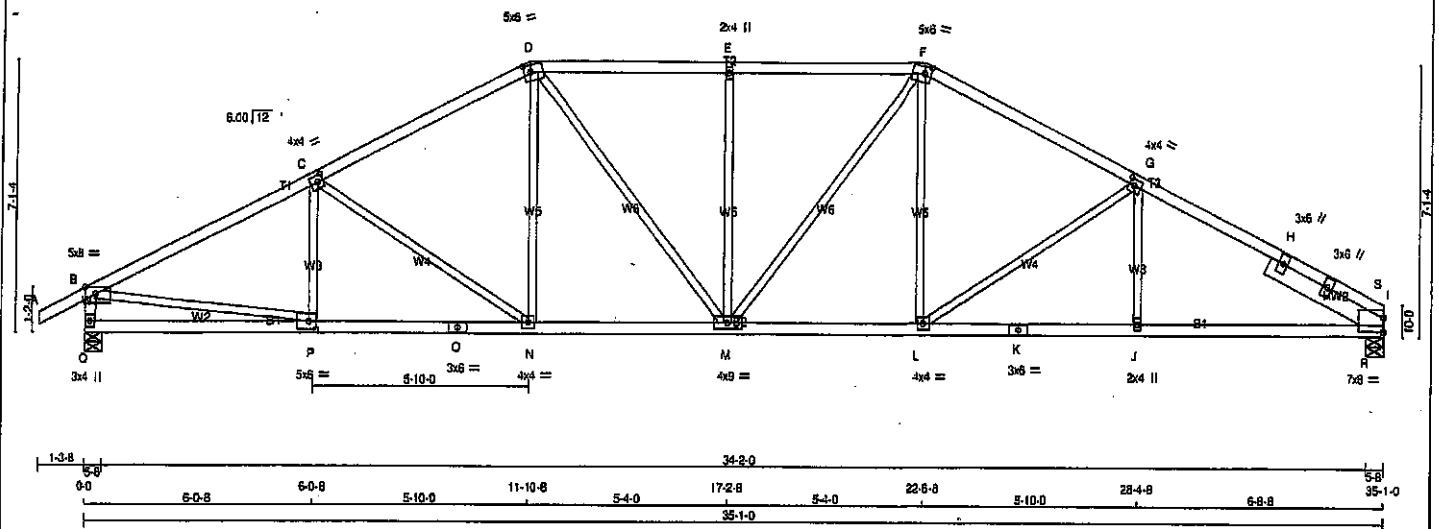

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - B	2x4	DRY	No.2
B - O	2x4	DRY	No.2
O - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2

REINFORCING MEMBERS

HW2	SIZE	LUMBER	DESCR.
HW2	2x6	DRY	No.2

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	3.50
C	TMVW-i	MT20	4.0	4.0	2.00	1.75
D	TTVW-m	MT20	5.0	8.0	2.25	2.00
E	TMVW-w	MT20	2.0	4.0		
F	TTVW-m	MT20	5.0	8.0	2.25	2.00
G	TMVW-i	MT20	4.0	4.0	2.00	1.75
I	TMBMR-i	MT20	7.0	8.0	4.50	
J	RT-i	MT20	3.0	6.0		
K	RT-i	MT20	3.0	6.0		
L	BMVW-w	MT20	2.0	4.0		
M	BMVW-w	MT20	3.0	6.0		
N	BMVW-i	MT20	4.0	4.0		
O	BS-i	MT20	3.0	6.0		
P	BMVW-i	MT20	5.0	6.0	2.50	2.25
Q	BMV-i	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	UP/LIFT	IN-SX	IN-SX
I	1834	0	1834	0	5-8	5-8
Q	2059	0	2059	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LOASE		MAX./MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
I	1388	898 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0
Q	1453	967 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I, Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO				
A-B	0 / 28	-91.8 -91.8 0.12 (1)	10.00	P-C -253 / 13 0.07 (1)
B-C	-2881 / 0	-91.8 -91.8 0.58 (1)	3.58	C-N -437 / 0 0.42 (1)
C-D	-2538 / 0	-91.8 -91.8 0.52 (1)	3.84	N-D 0 / 349 0.08 (1)
D-E	-2538 / 0	-91.8 -91.8 0.42 (1)	3.94	D-M 0 / 481 0.11 (1)
E-F	-2538 / 0	-91.8 -91.8 0.42 (1)	3.94	M-E -597 / 0 0.52 (1)
F-G	-2579 / 0	-91.8 -91.8 0.56 (1)	3.75	M-F 0 / 384 0.09 (1)
G-H	-2225 / 0	-91.8 -91.8 0.51 (1)	4.08	L-F 0 / 417 0.09 (1)
H-S	-2225 / 0	-91.8 -91.8 0.51 (1)	4.08	L-G -537 / 0 0.52 (1)
S-I	-2647 / 0	-91.8 -91.8 0.13 (1)	4.17	J-G 0 / 111 0.04 (4)
Q-B	-2009 / 0	0.0 0.0 0.20 (1)	5.95	R-S 0 / 2828 0.59 (1)
Q-P	0 / 0	-18.5 -18.5 0.15 (4)	10.00	R-H -1850 / 0 0.18 (1)
P-O	0 / 2802	-18.5 -18.5 0.49 (1)	10.00	
O-N	0 / 2802	-18.5 -18.5 0.49 (1)	10.00	
N-M	0 / 2241	-18.5 -18.5 0.43 (1)	10.00	
M-L	0 / 2301	-18.5 -18.5 0.46 (1)	10.00	
L-K	0 / 2744	-18.5 -18.5 0.53 (1)	10.00	
K-J	0 / 2744	-18.5 -18.5 0.53 (1)	10.00	
J-R	0 / 2744	-18.5 -18.5 0.68 (1)	10.00	
R-I	0 / 1303	-18.5 -18.5 0.45 (1)	10.00	

[M/F]

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")

CALCULATED VERT. DEFL.(LL) = L/999 (0.16")

ALLOWABLE DEFL.(TL) = L/360 (1.17")

CALCULATED VERT. DEFL.(TL) = L/999 (0.30")

CSI: TC=0.58/1.00 (B-C:1), BC=0.68/1.00 (J-R:1), WB=0.59/1.00 (B-P:1), SS=0.31/1.00 (I-R:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1867 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (P) (INPUT = 0.90)


JSI METAL= 0.98 (I) (INPUT = 1.00)



Structural component only
 DWG# T-2008066

JOB NAME 408317	TRUSS NAME T63	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Famarack Roof Truss, Burlington					

Version 8.316 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:48 2020 Page 1
ID:DMCubINVH6TstFoe31vg1 zns11-FrsYW9pcFT51IKKqCjrlL7rRH11eyDH7eG4tLZU
17-6-8 21-2-8 6-10-0 28-0-8 31-6-0
1-3-8 0-0 7-0-8 7-0-8 6-10-0 13-10-8 3-8-0 3-8-0 6-10-0 28-0-8 31-6-0
Scale = 1:51.4

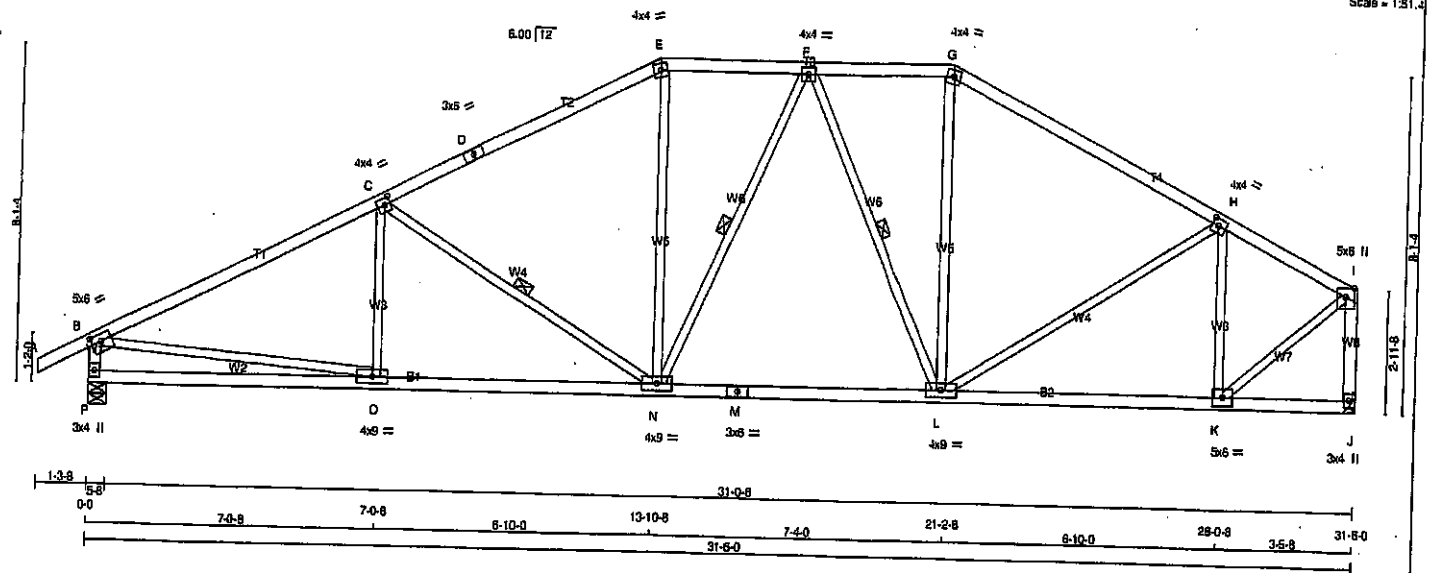

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	
CHORDS			
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
P - B	2x4	DRY	No.2
J - I	2x4	DRY	No.2
P - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A - B	TMWW-1	MT20	5.0	6.0	2.00 2.75
C - D	TMWW-1	MT20	4.0	4.0	2.00 1.75
D - E	TS-1	MT20	3.0	6.0	
E - F	TTW-m	MT20	4.0	4.0	
F - G	TMWW-1	MT20	4.0	4.0	
G - H	TTW-m	MT20	4.0	4.0	
H - I	TMWW-1	MT20	4.0	4.0	2.00 1.75
I - J	TMWW-p	MT20	5.0	6.0	Edge
J - K	BMV1+p	MT20	3.0	4.0	
K - L	BMWW-1	MT20	5.0	6.0	
L - M	BS-1	MT20	4.0	9.0	
M - N	BMWW-1	MT20	3.0	6.0	
N - O	BMWW-1	MT20	4.0	9.0	
O - P	BMWW-1	MT20	4.0	9.0	
P - J	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT				
P 1881	0	1881	0	5-8
J 1736	0	1736	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
P	1314	875 / 0	0 / 0	0 / 0	0 / 0	438 / 0	0 / 0
J	1228	806 / 0	0 / 0	0 / 0	0 / 0	422 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.50 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-N, F-N, F-L

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO				FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	O-C	-142 / 66	0.05 (1)
B-C	-2544 / 0	-91.8	-91.8 0.77 (1)	3.50	C-N	-880 / 0	0.31 (1)
C-D	-1971 / 0	-91.8	-91.8 0.67 (1)	4.01	N-E	0 / 497	0.11 (1)
D-E	-1971 / 0	-91.8	-91.8 0.67 (1)	4.01	N-F	-8 / 33	0.01 (4)
E-F	-1737 / 0	-91.8	-91.8 0.18 (1)	4.60	F-L	-438 / 0	0.22 (1)
F-G	-1558 / 0	-91.8	-91.8 0.17 (1)	5.12	L-G	0 / 387	0.08 (1)
G-H	-1763 / 0	-91.8	-91.8 0.59 (1)	4.35	L-H	0 / 275	0.05 (1)
H-I	-1426 / 0	-91.8	-91.8 0.43 (1)	4.93	K-H	-907 / 0	0.28 (1)
P-B	-1808 / 0	0.0	0.0 0.18 (1)	6.23	B-O	0 / 2323	0.52 (1)
J-I	-1718 / 0	0.0	0.0 0.27 (1)	6.35	K-I	0 / 1663	0.37 (1)
P-O	0 / 0	-18.5	-18.5 0.21 (4)	10.00			
C-N	0 / 2306	-18.5	-18.5 0.47 (1)	10.00			
N-M	0 / 1740	-18.5	-18.5 0.39 (1)	10.00			
M-L	0 / 1740	-18.5	-18.5 0.39 (1)	10.00			
L-K	0 / 1320	-18.5	-18.5 0.32 (1)	10.00			
K-J	0 / 0	-18.5	-18.5 0.12 (4)	10.00			

TOTAL WEIGHT = 135 lb
(M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6	PSF
DL	= 6.0	PSF
BOT CH. LL	= 0.0	PSF
DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TRC 2011, TRC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.05")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.10")
ALLOWABLE DEFL.(TL) = $L/360$ (1.05")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.20")

CSI: TC=0.77/1.00 (B-C:1), BC=0.47/1.00 (N-O:1), WB=0.52/1.00 (B-O:1), SS=0.28/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
	MAX	MIN	MAX
MT20	618	354	1887

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.89 (E) (INPUT = 0.80)
JSI METAL = 0.89 (B) (INPUT = 1.00)

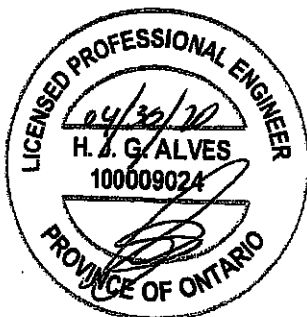

Structural component only
DWG# T-2008067

Structural component only
DWG# T-2008068

JOB NAME 408317	TRUSS NAME T65	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

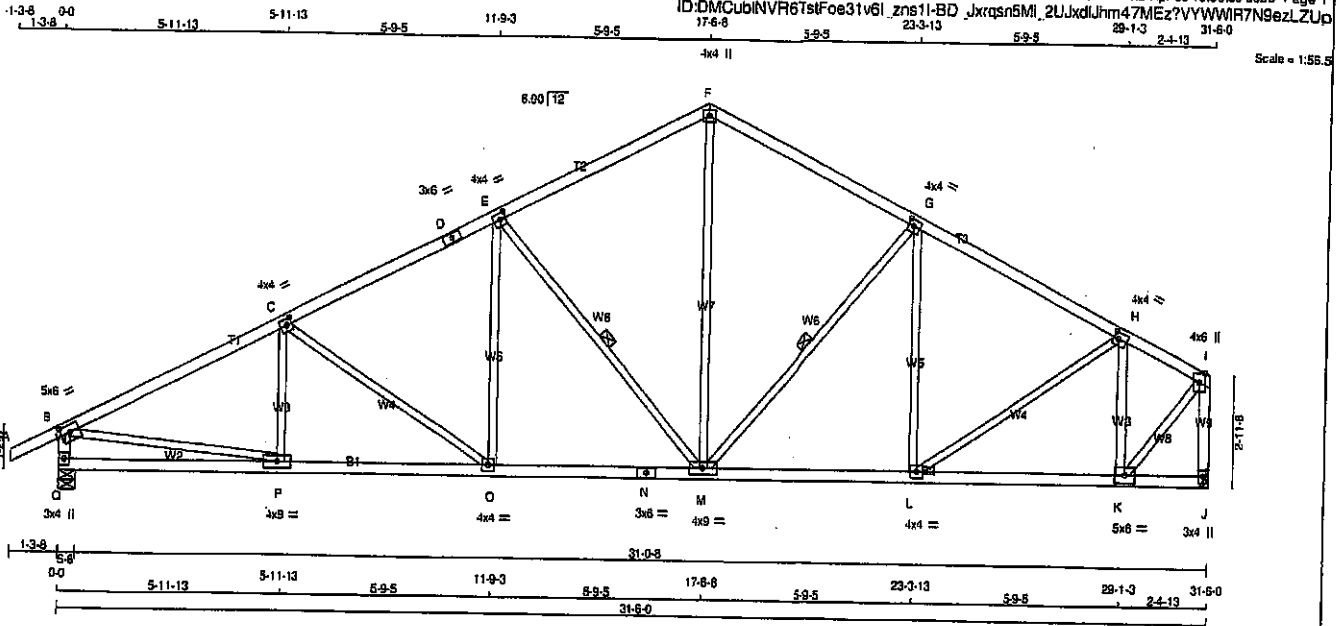

CHORDS	SIZE	LUMBER
A - D	2x4	DRY No.2
E - H	2x4	DRY No.2
I - L	2x4	DRY No.2
M - N	2x4	DRY No.2
O - P	2x4	DRY No.2
Q - R	2x4	DRY No.2
S - T	2x4	DRY No.2
U - V	2x4	DRY No.2
W - X	2x4	DRY No.2
Y - Z	2x4	DRY No.2
ALL WEBS	2x3	DRY No.2
EXCEPT		

DRY: SEASONED LUMBER.

PLATE TYPE	PLATES	W	LEN	Y	X
A - B	MT20	5.0	6.0	2.25	2.75
C - E	MT20	4.0	4.0	2.00	1.75
F - H	MT20	4.0	4.0		
I - L	MT20	4.0	4.0	2.00	1.50
M - N	MT20	4.0	6.0	Edge	
O - P	MT20	3.0	4.0		
Q - R	MT20	5.0	6.0		
S - T	MT20	4.0	4.0		
U - V	MT20	4.0	9.0		
W - X	MT20	3.0	6.0		
Y - Z	MT20	4.0	4.0		
AA - BB	MT20	4.0	9.0		
CC - DD	MT20	4.0	9.0		
EE - FF	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UP	IN-SX
Q	1881	0	1881	0
J	1736	0	1736	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3-8.

UNFACTORED REACTIONS

1ST CASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED
Q	1314
J	1228

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.86 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-M, G-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0.28	-91.8	-91.8 0.12 (1)	10.00	P-C	-209.25	0.06 (1)
B-C	-2522.0	-91.8	-91.8 0.52 (1)	3.88	C-O	-393.0	0.38 (3)
C-D	-2179.0	-91.8	-91.8 0.41 (1)	4.24	O-E	0.322	0.07 (1)
D-E	-2179.0	-91.8	-91.8 0.41 (1)	4.24	E-M	-832.0	0.45 (1)
E-F	-1598.0	-91.8	-91.8 0.40 (1)	4.80	M-F	0.985	0.22 (1)
F-G	-1599.0	-91.8	-91.8 0.41 (1)	4.79	M-G	-320.0	0.17 (1)
G-H	-1794.0	-91.8	-91.8 0.41 (1)	4.58	L-G	-269.0	0.23 (1)
H-I	-1145.0	-91.8	-91.8 0.18 (1)	5.74	L-H	0.1678	0.15 (1)
I-J	-1813.0	0.0	0.0 0.18 (1)	6.21	K-H	-1072.0	0.28 (1)
J-K	-1728.0	0.0	0.0 0.27 (1)	6.33	S-P	0.2299	0.52 (1)
					K-I	0.1565	0.35 (1)
Q-P	0.0	-18.5	-18.5 0.14 (4)	10.00			
P-O	0.2276	-18.5	-18.5 0.43 (1)	10.00			
O-N	0.1949	-18.5	-18.5 0.39 (1)	10.00			
N-M	0.1949	-18.5	-18.5 0.39 (1)	10.00			
M-L	0.1818	-18.5	-18.5 0.33 (1)	10.00			
L-K	0.1051	-18.5	-18.5 0.23 (1)	10.00			
K-J	0.0	-18.5	-18.5 0.09 (4)	10.00			

TOTAL WEIGHT = 3 X 138 = 413 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.5 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, NBCC 2015
- PART 9 OF OBC 2012, OBC 2012, ABC 2019
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.5 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.05")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL) = L/360 (1.05")
CALCULATED VERT. DEFL.(TL) = L/999 (0.19")

CSI: TC=0.52/1.00 (B-C:1), BC=0.43/1.00 (O-P:1), WB=0.52/1.00 (B-P:1), SS=0.23/1.00 (B-C:1)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MT20	618	354	1867
	788	1987	1866

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (P) (INPUT = 0.90)
JSI METAL= 0.67 (B) (INPUT = 1.00)




Structural component only
DWG# T-2008069

JOB NAME 408317	TRUSS NAME T66	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:52 2020 Page 1
ID:DMCubINVR61stFoe31v6l_zns11-HQYh8BrUYOUccC3WVKGYDzdLteEZEy3fz5sxh3zLZUo

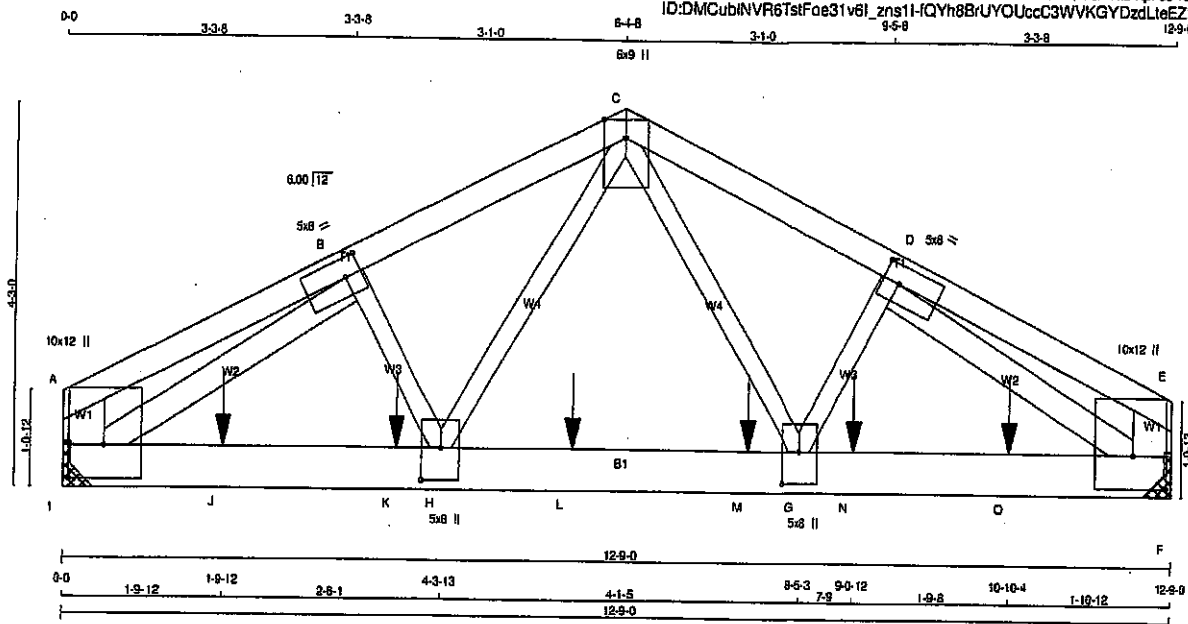

Scale = 1:23.7

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
I - A	2x6	DRY	No.2	SPF	
F - E	2x6	DRY	No.2	SPF	
I - F	2x6	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	
I - B	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C 1	12	TOP
C-E 1	12	TOP
I-A 2	12	TOP
F-E 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
I-F 2	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	
2x4 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	DOWN	IN-SX	IN-SX
I	5734	0	0	0
F	5980	0	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I.F. MINIMUM BEARING LENGTH AT JOINT I = 4-0, JOINT F = 4-0.

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
I	4050 2888 / 0 0 / 0 0 / 0 0 / 0 1384 / 0 0 / 0
F	4224 2802 / 0 0 / 0 0 / 0 0 / 0 1422 / 0 0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.18 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD LC1	MAX. FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	FORCE (LBS)	CS1 (LC)	UNBRAC LENGTH	MEMB.	FORCE (LBS)
FR-TO		FROM TO			FR-TO	
A-B	-3 / 0	-91.8 -91.8	0.09 (1)	10.00	C-G	0 / 4292
B-C	-7793 / 0	-91.8 -91.8	0.31 (1)	3.31	G-D	0 / 1062
C-D	-8218 / 0	-91.8 -91.8	0.34 (1)	3.19	H-C	0 / 3477
D-E	-4 / 0	-91.8 -91.8	0.10 (1)	10.00	S-H	0 / 978
I-A	-150 / 0	0.0 0.0	0.01 (1)	7.81	I-B	-8011 / 0
F-E	-154 / 0	0.0 0.0	0.01 (1)	7.81	D-F	-8439 / 0
I-J	0 / 6530	-18.5 -18.5	0.69 (1)	10.00		
J-K	0 / 6530	-18.5 -18.5	0.69 (1)	10.00		
K-H	0 / 6530	-18.5 -18.5	0.69 (1)	10.00		
H-L	0 / 5336	-18.5 -18.5	0.57 (1)	10.00		
L-M	0 / 5336	-18.5 -18.5	0.57 (1)	10.00		
M-G	0 / 5336	-18.5 -18.5	0.57 (1)	10.00		
G-N	0 / 6878	-18.5 -18.5	0.72 (1)	10.00		
N-O	0 / 6878	-18.5 -18.5	0.72 (1)	10.00		
O-F	0 / 6878	-18.5 -18.5	0.72 (1)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LCC	LC1	MAX	FACE	DIR.	TYPE	HEEL	CONN.
J	1-9-12	-1718	-1718	---	BACK	VERT	TOTAL	---
K	3-9-12	-1718	-1718	---	BACK	VERT	TOTAL	---
L	5-9-12	-1718	-1718	---	BACK	VERT	TOTAL	---
M	7-9-12	-1718	-1718	---	BACK	VERT	TOTAL	---
N	9-9-12	-1718	-1718	---	BACK	VERT	TOTAL	---
O	10-10-4	-1718	-1718	---	BACK	VERT	TOTAL	---

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 59 = 118 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.43")

CALCULATED VERT. DEFL.(LL) = L/999 (0.07")

ALLOWABLE DEFL.(TL) = L/360 (0.43")

CALCULATED VERT. DEFL.(TL) = L/999 (0.13")

CSI: TC=0.34/1.00 (C-D:1), BC=0.72/1.00 (F-G:1), WB=0.75/1.00 (D-F:1), SS=0.68/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN


MT20 618 354 1667 788 1987 1856

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.88 (D) (INPUT = 0.90)

JSI METAL= 0.78 (D) (INPUT = 1.00)

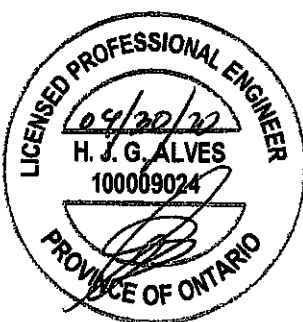

Structural component only
DWG# T-2008070

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408317	T66	1	2	GREEN PARK HOMES	


Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:52 2020 Page 2
ID:DMCubINVR8TsIFos31v6I_zns11-7c83MXs8JgTDMeI22nnmB9Wd2aozPJpCkUOXzLZUn

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A, E, F, I						
A	TMBMW1**p	MT20	10.0	12.0	4.50	4.75
B	TMBWW-i	MT20	5.0	8.0	2.50	2.25
C	TTWW+p	MT20	8.0	9.0	Edge	
D	TMBWW-i	MT20	5.0	8.0	2.50	2.25
E	TMBMW1**p	MT20	10.0	12.0	4.50	4.75
G	BMBWW-i	MT20	5.0	8.0	4.25	2.50
H	BMBWW-i	MT20	5.0	8.0	4.25	2.50

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

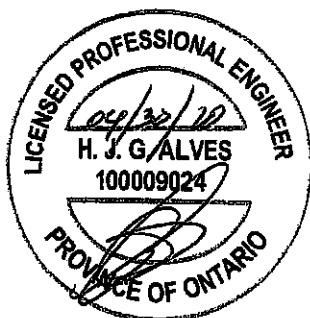


Structural component only
DWG# T-2008070 3/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408317	T67S	1	1	GREEN PARK HOMES	
TRUSS DESC.					

Yamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 10:50:53 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns11-bogRZssk40kKwDuc10i0ikJS2fz9yRPL11zzLZUm

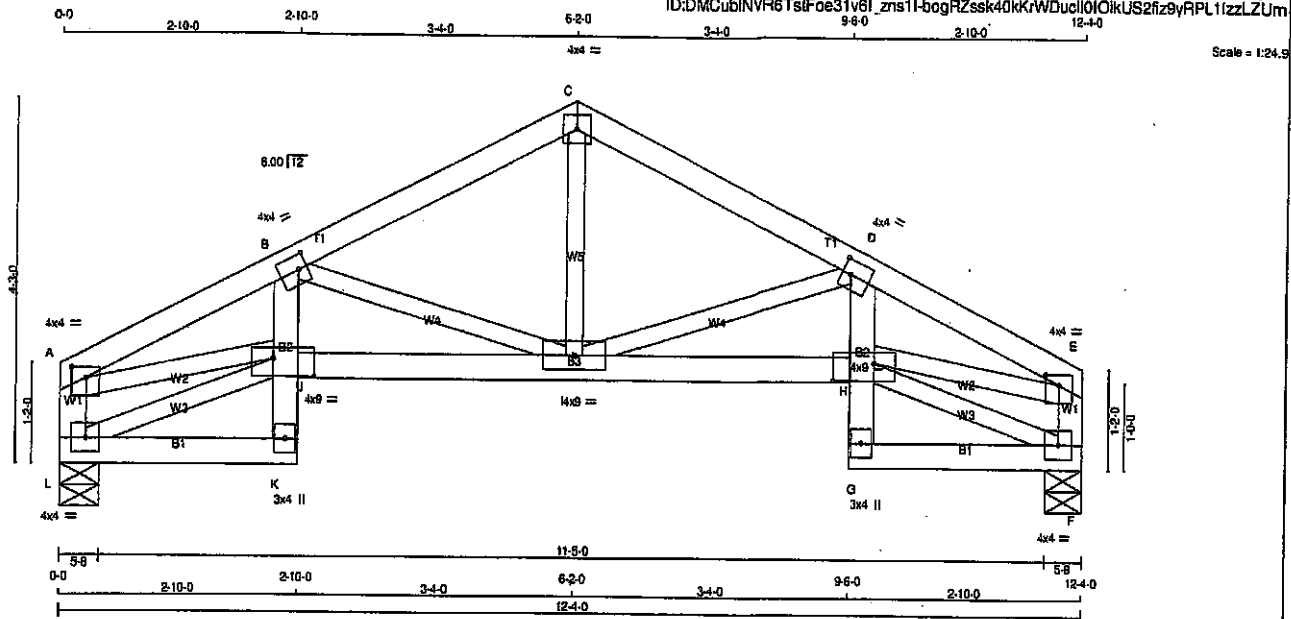

Scale = 1:24.5

LUMBER			
N L G A RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
L - A	2x4	DRY	No.2
F - E	2x4	DRY	No.2
L - K	2x4	DRY	No.2
K - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
G - D	2x4	DRY	No.2
G - F	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
SPF			
DRY: SEASONED LUMBER.			

PLATES (Table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW-p	MT20	4.0	4.0	1.50 2.00
B	TMVW-i	MT20	4.0	4.0	2.00 1.25
C	TTW-p	MT20	4.0	4.0	
D	TMVW-i	MT20	4.0	4.0	2.00 1.25
E	TMVW-p	MT20	4.0	4.0	1.50 2.00
F	BMVW-1	MT20	4.0	4.0	
G	BMV-p	MT20	3.0	4.0	
H	BMVWV-1	MT20	4.0	9.0	2.50 6.00
I	BMVWV-1	MT20	4.0	9.0	
J	BMVWV-1	MT20	4.0	9.0	2.50 6.00
K	BMV-p	MT20	3.0	4.0	
L	BMVW-1	MT20	4.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	DOWN	HORZ	BRG	IN-SX	BRG	IN-SX
L	680	0	680	0	0	5-8	5-8		
F	680	0	680	0	0	5-8	5-8		

UNFACTORED REACTIONS		1ST LOOSE		MAX./MIN. COMPONENT REACTIONS		SNOW		LIVE		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED																
L	481	316 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	165 / 0	0 / 0	0 / 0	0 / 0
F	481	316 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	165 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.55 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX. (LC)	UNBRAC	MEMB.	FORCE (LBS)	MAX. (LC)	UNBRAC
FR-TO		FROM	TO		LENGTH	FR-TO			
A-B	-1320 / 0	-91.8	-91.8	0.09 (1)	5.55	I-C	0 / 443	0.10 (1)	
B-C	-818 / 0	-91.8	-91.8	0.14 (1)	6.25	I-D	-558 / 0	0.13 (1)	
C-D	-818 / 0	-91.8	-91.8	0.14 (1)	6.25	B-I	-558 / 0	0.13 (1)	
D-E	-1320 / 0	-91.8	-91.8	0.09 (1)	5.55	L-J	-74 / 0	0.01 (1)	
L-A	-829 / 0	0.0	0.0	0.06 (1)	7.81	A-J	0 / 1193	0.27 (1)	
F-E	-829 / 0	0.0	0.0	0.06 (1)	7.81	H-F	-74 / 0	0.01 (1)	
						H-E	0 / 1193	0.27 (1)	
L-K	0 / 69	-18.5	-18.5	0.04 (4)	10.00				
K-J	0 / 28	0.0	0.0	0.10 (1)	10.00				
J-B	0 / 87	0.0	0.0	0.11 (1)	10.00				
J-I	0 / 1249	-18.5	-18.5	0.24 (1)	10.00				
I-H	0 / 1249	-18.5	-18.5	0.24 (1)	10.00				
G-H	0 / 28	0.0	0.0	0.10 (1)	10.00				
H-D	0 / 87	0.0	0.0	0.11 (1)	10.00				
G-F	0 / 69	-18.5	-18.5	0.04 (4)	10.00				

TOTAL WEIGHT = 52 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.5 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 089-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.41")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL) = L/300 (0.41")
CALCULATED VERT. DEFL.(TL) = L/999 (0.08")

CSI: TO=0.14/1.00 (B-C:1), BC=0.24/1.00 (I-J:1), WB=0.27/1.00 (A-J:1), SI=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.86 (E) (INPUT = 0.90)
JSI METAL= 0.40 (A) (INPUT = 1.00)



Structural component only
DWG# T-2008071

Scale 1: 24 c

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	-1445 / 0	-91.8	-91.8	0.10 (1)	5.35	B-I	-634 / 0 0.15 (1)
B-C	-871 / 0	-91.8	-91.8	0.14 (1)	6.25	I-C	0 / 493 0.11 (1)
C-D	-871 / 0	-91.8	-91.8	0.14 (1)	6.25	I-D	-833 / 0 0.15 (1)
D-E	-1444 / 0	-91.8	-91.8	0.10 (1)	5.35	L-A	-88 / 0 0.02 (1)
L-A	-648 / 0	0.0	0.0	0.07 (1)	7.81	A-J	0 / 1307 0.29 (1)
F-E	-648 / 0	0.0	0.0	0.07 (1)	7.81	H-F	-88 / 0 0.02 (1)
						H-E	0 / 1306 0.29 (1)
L-K	0 / 81	-18.5	-18.5	0.05 (4)	10.00		
K-J	0 / 30	0.0	0.0	0.11 (1)	10.00		
J-B	0 / 135	0.0	0.0	0.13 (1)	10.00		
J-I	0 / 1370	-18.5	-18.5	0.25 (1)	10.00		
I-H	0 / 1369	-18.5	-18.5	0.25 (1)	10.00		
G-H	0 / 30	0.0	0.0	0.11 (1)	10.00		
H-D	0 / 134	0.0	0.0	0.13 (1)	10.00		
G-F	0 / 81	-18.5	-18.5	0.05 (4)	10.00		

JSI GRIP= 0.76 (A) (INPUT = 0.90)
JSI METAL= 0.38 (E) (INPUT = 1.00)



Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:50:54 2020 Page 1
ID:DMCubINVR6TstFos31v6l_zns11-4?DpnCiMrJsBTgo5ASqFrFuGrHpRIIsq25blPzLZU



CONTINUED ON PAGE 2


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408317	T68	1	2	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:54 2020 Page 2
ID:DMCubINvR6TstFoe31v6l zns1-4?DpnCiMrJsBTao5ASqFrcFuGrHoRn5o25bIPzLZU

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TTWW-m	MT20	5.0	8.0	2.00	2.25
C	TMV+p	MT20	3.0	4.0		
D	BMVW1-t	MT20	5.0	6.0	2.50	2.50
E	BMWW-t	MT20	6.0	9.0		
F	BMV1+p	MT20	3.0	6.0		

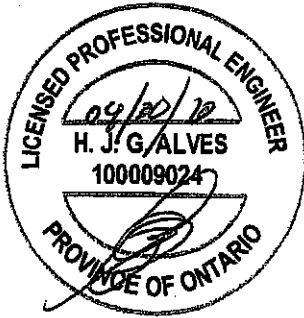


Structural component only
DWG# T-2008073

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408317	T69	1	1	TRUSS DESC.		

Hamack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Thu Apr 30 10:50:56 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-ONLaBuvdN6vixzTHtsjw1K5i1nvXO7MailMzLZUj

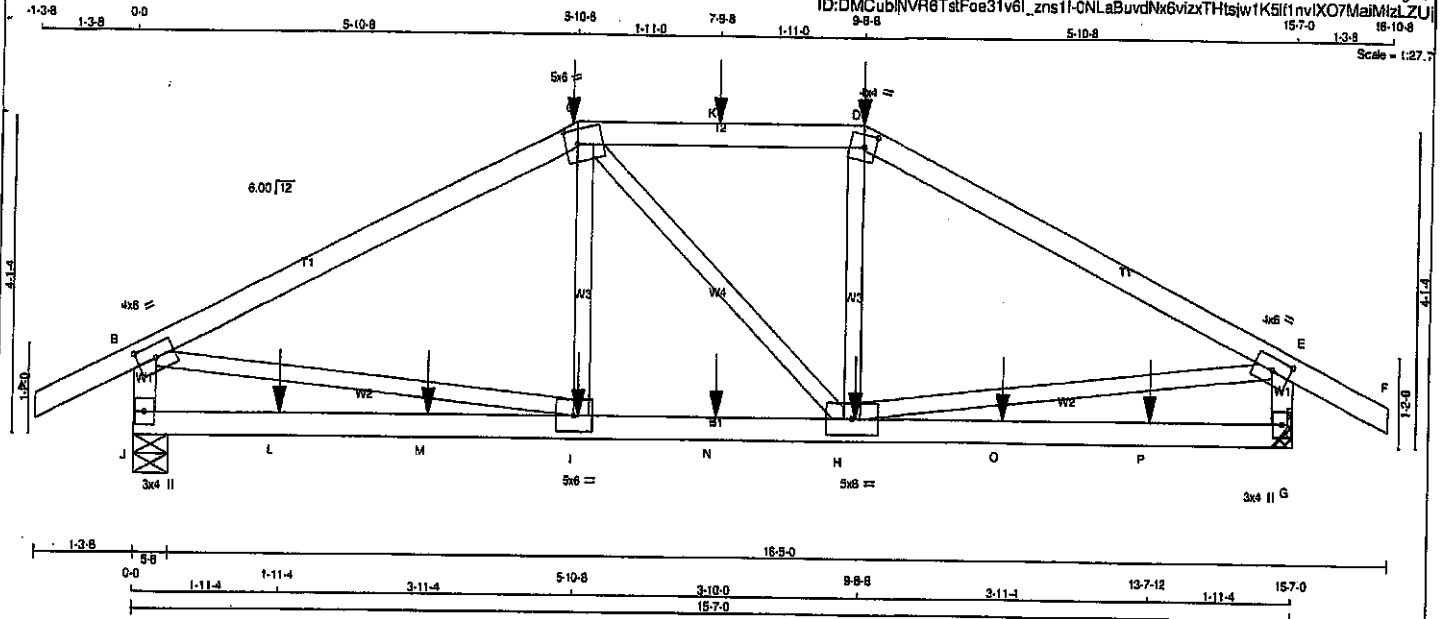

TOTAL WEIGHT = 61 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY				DESIGN CRITERIA			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD	SPECIFIED LOADS:	
A - C	2x4	DRY	No. 2	SPF	FACTORED	GROSS REACTION	GROSS REACTION	BRG	BRG	TOP CH. LL = 25.6 PSF	
C - D	2x4	DRY	No. 2	SPF	JT	VERT	DOWN	UPLIFT	IN-SX	DL = 8.0 PSF	
D - F	2x4	DRY	No. 2	SPF	J	1544	0	0	5-8	BOT CH. LL = 0.0 PSF	
F - H	2x4	DRY	No. 2	SPF	G	1543	0	0	MECHANICAL	DL = 7.4 PSF	
H - I	2x4	DRY	No. 2	SPF						TOTAL LOAD = 39.0 PSF	
I - G	2x4	DRY	No. 2	SPF							
ALL WEBS	2x3	DRY	No. 2	SPF	A SUITABLE HANGERMECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.						
EXCEPT										SPACING = 24.0 IN. C/C	

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	8.0	2.00	3.00
C	TTWW-m	MT20	5.0	8.0	2.25	2.00
D	TTWW-m	MT20	4.0	4.0	2.00	1.75
E	TMVW-t	MT20	4.0	8.0	2.00	3.00
G	BMV1+p	MT20	3.0	4.0		
H	BMVWW-t	MT20	5.0	8.0		
I	BMVWW-t	MT20	5.0	8.0		
J	BMV1+p	MT20	3.0	4.0		

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	1091	722/0	0/0	0/0	0/0	369/0	0/0
G	1090	722/0	0/0	0/0	0/0	369/0	0/0

BEARING MATERIAL TO BE SPF NO. 2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.85 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)


CHORDS				WEBS			
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. FACTORED (PLF)	MEMB.	FORCE (LBS)	MAX. FACTORED (PLF)	MAX. FACTORED (LBS)
FR-TO				FR-TO			
A-B	0/28	-91.8	-91.8 0.13 (1)	I-C	-75/105	0.04 (4)	0.04 (4)
B-C	-1873/0	-91.8	-91.8 0.78 (1)	C-H	0/3	0.00 (4)	0.00 (4)
C-D	-1874/0	-91.8	-91.8 0.47 (1)	H-D	-73/107	0.04 (4)	0.04 (4)
D-E	-1874/0	-91.8	-91.8 0.47 (1)	B-I	0/1691	0.42 (1)	0.42 (1)
E-F	-1876/0	-91.8	-91.8 0.78 (1)	H-E	0/1694	0.42 (1)	0.42 (1)
F-G	0/28	-91.8	-91.8 0.13 (1)				
J-B	-1474/0	0.0	0.0 0.16 (1)				
G-E	-1473/0	0.0	0.0 0.16 (1)				
J-L	0/0	-18.5	-18.5 0.28 (4)				
L-M	0/0	-18.5	-18.5 0.28 (4)				
M-I	0/0	-18.5	-18.5 0.28 (4)				
I-N	0/1672	-18.5	-18.5 0.40 (1)				
N-H	0/1672	-18.5	-18.5 0.40 (1)				
H-O	0/0	-18.5	-18.5 0.26 (4)				
O-P	0/0	-18.5	-18.5 0.26 (4)				
P-G	0/0	-18.5	-18.5 0.26 (4)				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-414	-414	---	FRONT	VERT	TOTAL	---	C1
D	9-8-8	-414	-414	---	FRONT	VERT	TOTAL	---	C1
H	9-7-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
I	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
K	7-9-8	-110	-110	---	FRONT	VERT	TOTAL	---	C1
L	1-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
M	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
N	7-9-8	-26	-26	---	FRONT	VERT	TOTAL	---	C1
O	11-7-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
P	13-7-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


1) C1: A SUITABLE HANGERMECHANICAL CONNECTION IS REQUIRED.

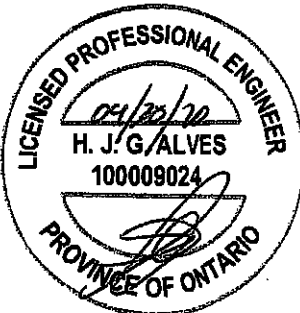

Structural component only
DWG# T-2008074

JOB NAME 408317	TRUSS NAME T70	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:50:57 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1I-UavyPEwF8EEmk7WfrbNyTE(OK3M9gYMOJFukzLZUj

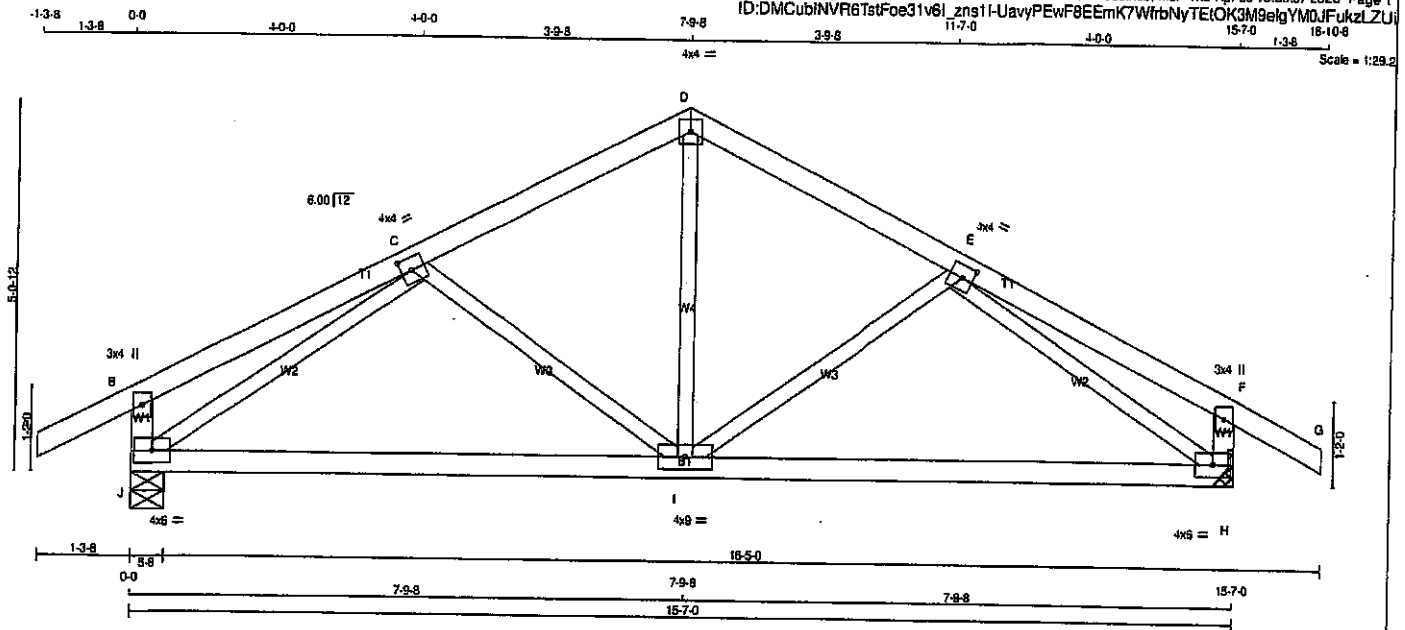

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR
A - D	2x4	DRY	No.2	SPF		
D - G	2x4	DRY	No.2	SPF		
J - B	2x4	DRY	No.2	SPF		
H - F	2x4	DRY	No.2	SPF		
J - H	2x4	DRY	No.2	SPF		
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV-p	MT20	3.0	4.0		
C	TMWW-1	MT20	4.0	4.0	2.00	1.75
D	TTW-p	MT20	4.0	4.0		
E	TMWW-1	MT20	4.0	4.0	2.00	1.75
F	TMV-p	MT20	3.0	4.0		
H	BMVW1-1	MT20	4.0	6.0		
I	BMVWW-1	MT20	4.0	9.0		
J	BMVW1-1	MT20	4.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UPLIFT	IN-SX
J	984	0	0	5-8
H	984	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	893	488 / 0	0 / 0	0 / 0	0 / 0	225 / 0	0 / 0
H	893	488 / 0	0 / 0	0 / 0	0 / 0	225 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 28	-91.8 -91.8	0.12 (1)	1-D	0 / 455	0.10 (1)	
B-C	0 / 18	-91.8 -91.8	0.21 (1)	1-E	-237 / 0	0.09 (1)	
C-D	-835 / 0	-91.8 -91.8	0.17 (1)	1-F	-237 / 0	0.09 (1)	
D-E	-835 / 0	-91.8 -91.8	0.17 (1)	1-G	-1137 / 0	0.43 (1)	
E-F	0 / 18	-91.8 -91.8	0.21 (1)	1-H	-1137 / 0	0.43 (1)	
F-G	0 / 28	-91.8 -91.8	0.12 (1)				
J-B	-284 / 0	0.0 0.0	0.03 (1)				
H-F	-284 / 0	0.0 0.0	0.03 (1)				
J-I	0 / 923	-18.5 -18.5	0.39 (4)				
I-H	0 / 923	-18.5 -18.5	0.39 (4)				

TOTAL WEIGHT = 61 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.8 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.52")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.02")
ALLOWABLE DEFL.(TL) = $L/360$ (0.52")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.10")

CSI: TC=0.21/1.00 (E-F:1), BC=0.39/1.00 (I-J:4), WB=0.43/1.00 (C-J:1), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSH)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788
		1687 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP = 0.81 (E) (INPUT = 0.90)
JSI METAL = 0.38 (E) (INPUT = 1.00)



Structural component only
DWG# T-2008075

JOB NAME 408317	TRUSS NAME T71	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Taharack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 10:50:58 2020 Page 1
 ID:DMCubINVR6TstFoe31v61_zns1l-ymTKcawtvYMDxH5sPluB?SPa?TkwNEGhag3oRAzLZUH
 9-11-8 13-5-9 14-8-8
 Scale = 1:25.0

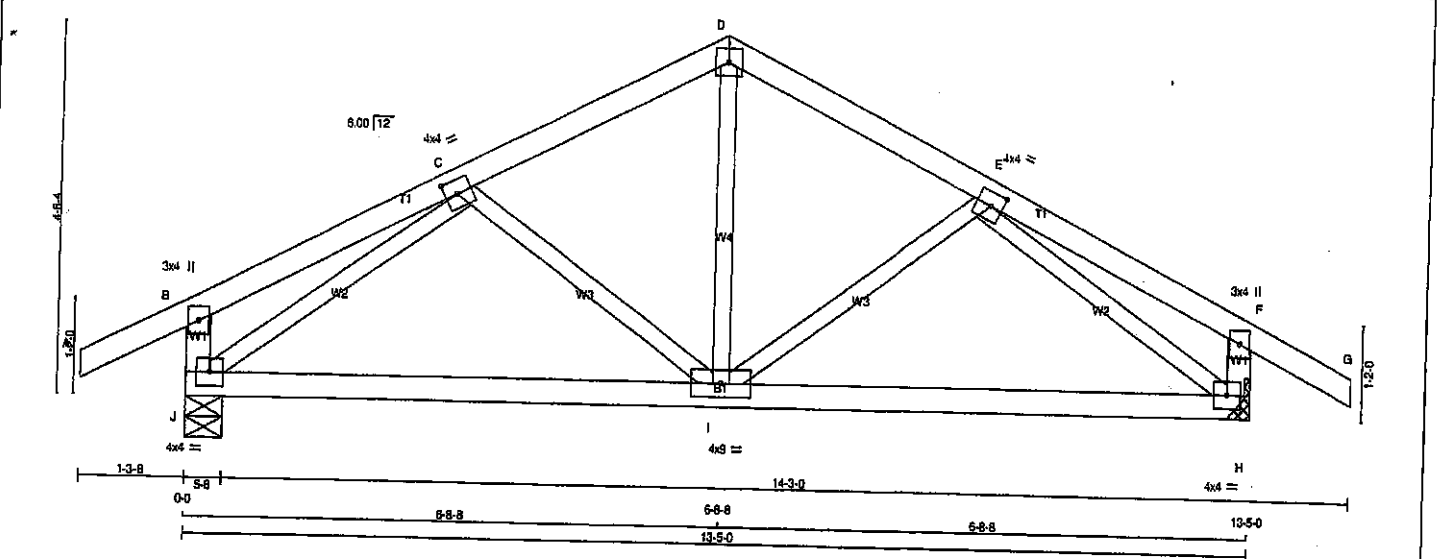

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - G	2x4	DRY No.2	SPF
J - B	2x4	DRY No.2	SPF
H - F	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV-p	MT20	3.0	4.0		
C	TMVW-1	MT20	4.0	4.0	2.00	1.75
D	TTW-p	MT20	4.0	4.0		
E	TMVW-1	MT20	4.0	4.0	2.00	1.75
F	TMV-p	MT20	3.0	4.0		
H	BMVW-1	MT20	4.0	4.0		
I	BMVW-1	MT20	4.0	9.0		
J	BMVW-1	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	IN-SX	
J	864	0	5-8	
H	864	0	5-8	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
J	609	413 / 0	0 / 0	0 / 0	196 / 0	0 / 0
H	609	413 / 0	0 / 0	0 / 0	196 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	D	0 / 371 0.08 (1)	
B-C	0 / 15	-91.8	-91.8 0.15 (1)	10.00	E	-181 / 0 0.05 (1)	
C-D	-998 / 0	-91.8	-91.8 0.12 (1)	6.25	C-I	-181 / 0 0.05 (1)	
D-E	-998 / 0	-91.8	-91.8 0.12 (1)	6.25	J-C	-946 / 0 0.28 (1)	
E-F	0 / 15	-91.8	-91.8 0.15 (1)	10.00	E-H	-946 / 0 0.28 (1)	
F-G	0 / 28	-91.8	-91.8 0.12 (1)	10.00			
G-H	-246 / 0	0.0	0.0 0.02 (1)	7.81			
H-I	-246 / 0	0.0	0.0 0.02 (1)	7.81			
J-I	0 / 755	-18.5	-18.5 0.29 (4)	10.00			
I-H	0 / 755	-18.5	-18.5 0.29 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF

BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.45")
 CALCULATED VERT. DEFL.(LL) = $L/999$ (0.02")
 ALLOWABLE DEFL.(TL) = $L/360$ (0.45")
 CALCULATED VERT. DEFL.(TL) = $L/999$ (0.08")

CSI: TC=0.15/1.00 (E-F:1), BC=0.29/1.00 (H:4), WB=0.28/1.00 (E-H:1), SS=0.13/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1667 788 1967 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.85 (J) (INPUT = 0.60)
 JSI METAL = 0.32 (E) (INPUT = 1.00)




Structural component only
 DWG# T-2008076

JOB NAME 408317	TRUSS NAME T72S	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:50:59 2020 Page 1
ID:DMCubINVR6TsiFos31v6I_zns11-Qv1iqwxVgsUJZRp2z0PQYfj0s3j6frpKdMzdzLZUg

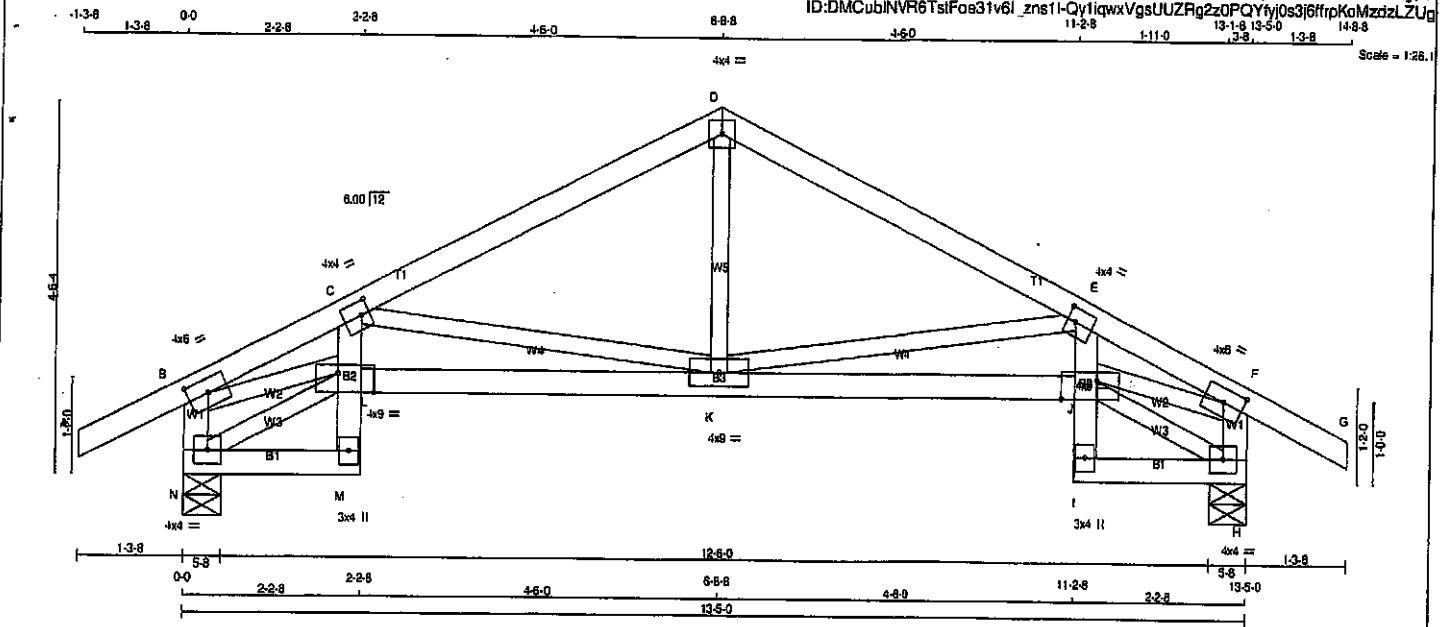

TOTAL WEIGHT = 2 X 57 = 114 lb [M/F]

LUMBER			
N. L. & A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
N - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
N - M	2x4	DRY	No.2
M - C	2x4	DRY	No.2
L - J	2x4	DRY	No.2
I - E	2x4	DRY	No.2
I - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	6.0	2.00	3.00
C	TMVW-1	MT20	4.0	4.0	2.00	1.25
D	TTW-p	MT20	4.0	4.0		
E	TMVW-1	MT20	4.0	4.0	2.00	1.25
F	TMVW-1	MT20	4.0	6.0	2.00	3.00
H	BMVW-1	MT20	4.0	4.0		
I	BMVW-1	MT20	3.0	4.0		
J	BMVW-1	MT20	4.0	9.0	2.75	5.50
K	BMVW-1	MT20	4.0	9.0		
L	BMVW-1	MT20	4.0	9.0	2.75	5.50
M	BMVW-1	MT20	3.0	4.0		
N	BMVW-1	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORIZ	DOWN	HORIZ
N	884	0	884	0
H	884	0	884	0

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
N	COMBINED	413 / 0	0 / 0	0 / 0	0 / 0	198 / 0	0 / 0	0 / 0
H	COMBINED	413 / 0	0 / 0	0 / 0	0 / 0	198 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.07 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 20	-91.8	-91.8 0.12 (1)	10.00	K-D	0 / 412	0.09 (1)
B-C	-1616 / 0	-91.8	-91.8 0.15 (1)	5.07	K-E	-812 / 0	0.30 (1)
C-D	-892 / 0	-91.8	-91.8 0.20 (1)	6.18	C-K	-812 / 0	0.30 (1)
D-E	-892 / 0	-91.8	-91.8 0.20 (1)	6.18	N-L	-116 / 0	0.02 (1)
E-F	-1616 / 0	-91.8	-91.8 0.15 (1)	5.07	E-L	0 / 1472	0.33 (1)
F-G	0 / 28	-91.8	-91.8 0.12 (1)	10.00	J-H	-116 / 0	0.02 (1)
N-B	-795 / 0	0.0	0.0 0.08 (1)	7.81	J-F	0 / 1472	0.33 (1)
H-F	-795 / 0	0.0	0.0 0.08 (1)	7.81			
N-M	0 / 104	-18.5	-18.5 0.03 (4)	10.00			
M-L	0 / 21	0.0	0.0 0.14 (1)	10.00			
L-C	0 / 102	0.0	0.0 0.16 (1)	10.00			
L-K	0 / 1585	-18.5	-18.5 0.32 (1)	10.00			
K-J	0 / 1585	-18.5	-18.5 0.32 (1)	10.00			
I-J	0 / 21	0.0	0.0 0.14 (1)	10.00			
J-E	0 / 102	0.0	0.0 0.16 (1)	10.00			
I-H	0 / 104	-18.5	-18.5 0.03 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.45")
CALCULATED VERT. DEFL.(LL) = L/999 (0.04")
ALLOWABLE DEFL.(TL) = L/360 (0.45")
CALCULATED VERT. DEFL.(TL) = L/999 (0.08")

CSI: TC=0.28/1.00 (D-E:1), BC=0.32/1.00 (J-K:1),
WB=0.33/1.00 (F-J:1), SS=0.17/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PS)	(PL)	(PL)
MT20	618	354	1667 788 1987 1666

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.88 (C) (INPUT = 0.90)
JSI METAL = 0.43 (B) (INPUT = 1.00)




Structural component only
DWG# T-2008077

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408316	V30	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:05:39 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-3pgRys0LE8oPFQkHdmcaJ3lwzCqoqoZKTM9wRWGzLa9A

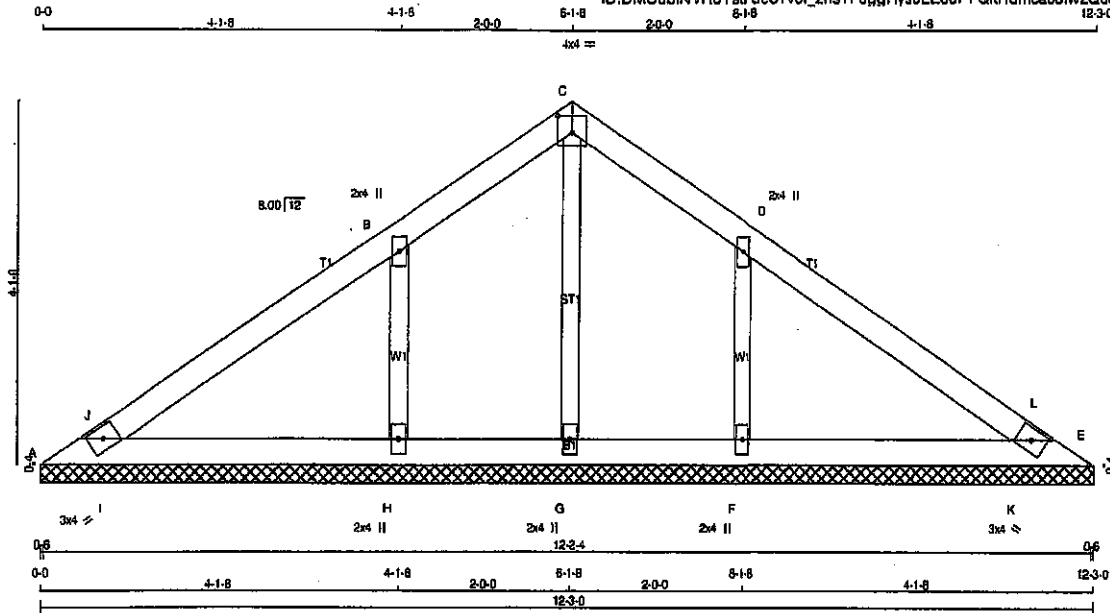

Scale: 1/2"=1'

TOTAL WEIGHT = 36 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.	SPF
A - C	2x4	DRY	No.2	SPF			
C - E	2x4	DRY	No.2	SPF			
A - E	2x4	DRY	No.2	SPF			
ALL WEBS	2x3	DRY	No.2	SPF			
DRY: SEASONED LUMBER.							

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TBM1-h	MT20	3.0	4.0		
B	TMW-w	MT20	2.0	4.0		
C	TTW-p	MT20	4.0	4.0	2.25	2.00
D	TMW-w	MT20	2.0	4.0		
E	TBM1-h	MT20	3.0	4.0		
F, G, H	BMW1-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REQD
JT	VERT	HORZ	DOWN	UPLIFT
A	102	0	102	0
E	102	0	102	0
G	252	0	252	0
H	444	0	444	0
F	444	0	444	0

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED							
A	72	48/0	0/0	0/0	0/0	24/0	0/0	0/0
E	72	48/0	0/0	0/0	0/0	24/0	0/0	0/0
G	178	115/0	0/0	0/0	0/0	84/0	0/0	0/0
H	314	208/0	0/0	0/0	0/0	108/0	0/0	0/0
F	314	208/0	0/0	0/0	0/0	108/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, G, H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS1 (LC)	MAX. FACTORED UNBRAC LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)
FR-TO						FR-TO			
A-J	0/150	-91.8	-91.8	0.04 (4)	10.00	G-C	-291/0	0.07 (1)	
J-B	0/183	-91.8	-91.8	0.17 (1)	10.00	H-B	-318/0	0.05 (1)	
B-C	0/151	-91.8	-91.8	0.18 (1)	10.00	F-D	-318/0	0.05 (1)	
C-D	0/151	-91.8	-91.8	0.18 (1)	10.00	I-J	-119/3	0.00 (1)	
D-L	0/183	-91.8	-91.8	0.17 (1)	10.00	K-L	-119/3	0.00 (1)	
L-E	0/150	-91.8	-91.8	0.04 (4)	10.00				
A-I	-158/0	-18.5	-18.5	0.10 (1)	8.25				
I-H	-137/0	-18.5	-18.5	0.10 (1)	8.25				
H-G	-148/0	-18.5	-18.5	0.08 (1)	6.25				
G-F	-148/0	-18.5	-18.5	0.08 (1)	6.25				
F-K	-137/0	-18.5	-18.5	0.10 (1)	6.25				
K-E	-166/0	-18.5	-18.5	0.10 (1)	6.25				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.17/1.00 (B-J:1), BC=0.10/1.00 (H-I:1), WB=0.07/1.00 (C-G:1), SS=0.12/1.00 (B-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.24 (C) (INPUT = 0.50)
JSI METAL= 0.16 (D) (INPUT = 1.00)




Structural component only
DWG# T-2008048

JOB NAME 408316	TRUSS NAME V31	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 8 Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:05:40 2020 Page 1
ID:DMCubINVR6TstFos31v6I_zns11-XsEpAC12?RwGsaJUB7prHr5Lp7QX?Adaptf_2jzLa9g

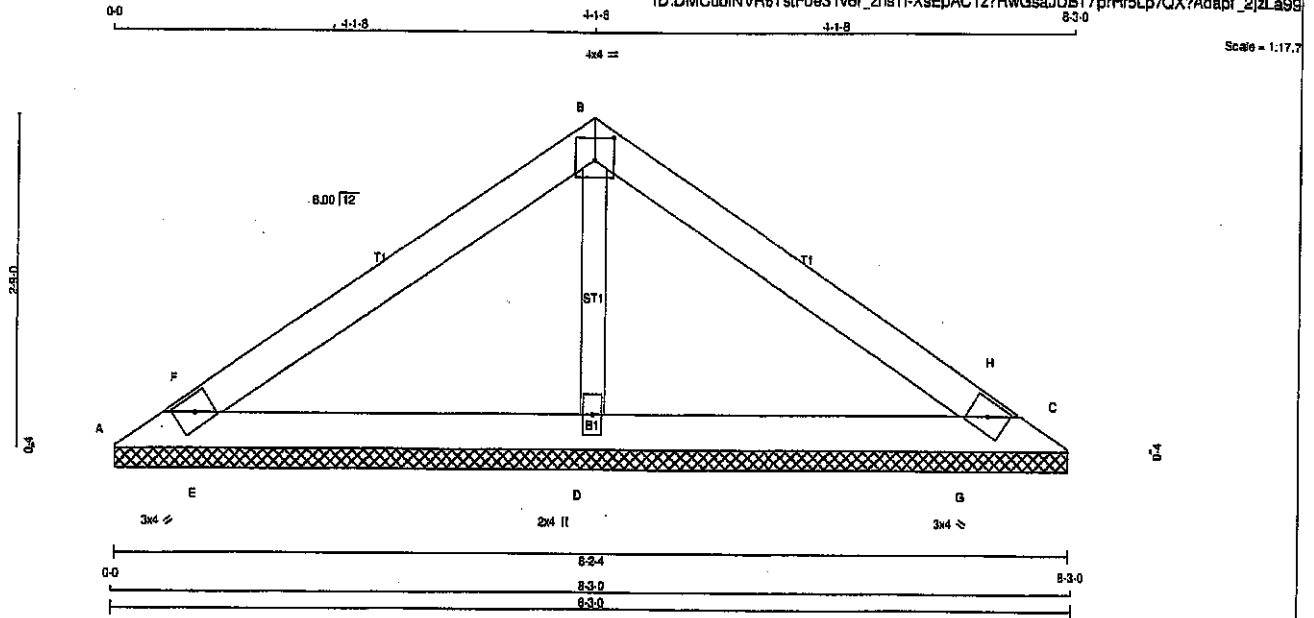

TOTAL WEIGHT = 21 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	No.2	DESCR.	SPF
A - B	2x4	DRY	No.2	SPF	
B - C	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TBM1-h	MT20	3.0	4.0		
B	TTW-p	MT20	4.0	4.0	2.25	2.00
C	TBM1-h	MT20	3.0	4.0		
D	BMW1-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
A	61	0	61	0	0	8-2-4	8-2-4
C	61	0	61	0	0	8-2-4	8-2-4
D	780	0	780	0	0	8-2-4	8-2-4

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	43	28 / 0	0 / 0	0 / 0	0 / 0	15 / 0	0 / 0	0 / 0
C	43	28 / 0	0 / 0	0 / 0	0 / 0	15 / 0	0 / 0	0 / 0
D	562	362 / 0	0 / 0	0 / 0	0 / 0	190 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO		FR-TO			
A-F	0 / 280	-91.8	-91.8 0.09 (1)	10.00	D-B	-598 / 0	0.10 (1)
F-B	0 / 279	-91.8	-91.8 0.19 (1)	10.00	E-F	-195 / 0	0.00 (1)
B-H	0 / 279	-91.8	-91.8 0.19 (1)	10.00	G-H	-195 / 0	0.00 (1)
H-C	0 / 280	-91.8	-91.8 0.09 (1)	10.00			
A-E	-264 / 0	-18.5	-18.5 0.14 (1)	8.25			
E-D	-237 / 0	-18.5	-18.5 0.14 (1)	8.25			
D-G	-237 / 0	-18.5	-18.5 0.14 (1)	8.25			
G-C	-264 / 0	-18.5	-18.5 0.14 (1)	8.25			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(85 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.18/1.00 (B-F:1), BC=0.14/1.00 (D-E:1), WB=0.10/1.00 (B-D:1), SS=0.10/1.00 (B-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	518	354	1887
	518	354	1887

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.50 (B) (INPUT = 0.90)
JSI METAL = 0.17 (B) (INPUT = 1.00)




Structural component only
DWG# T-2008049

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408315	PB1	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 09:31:23 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-G8RBRrRhQQmdaTZ8BzkR_V8akd5i4i6raHdLRzLaf

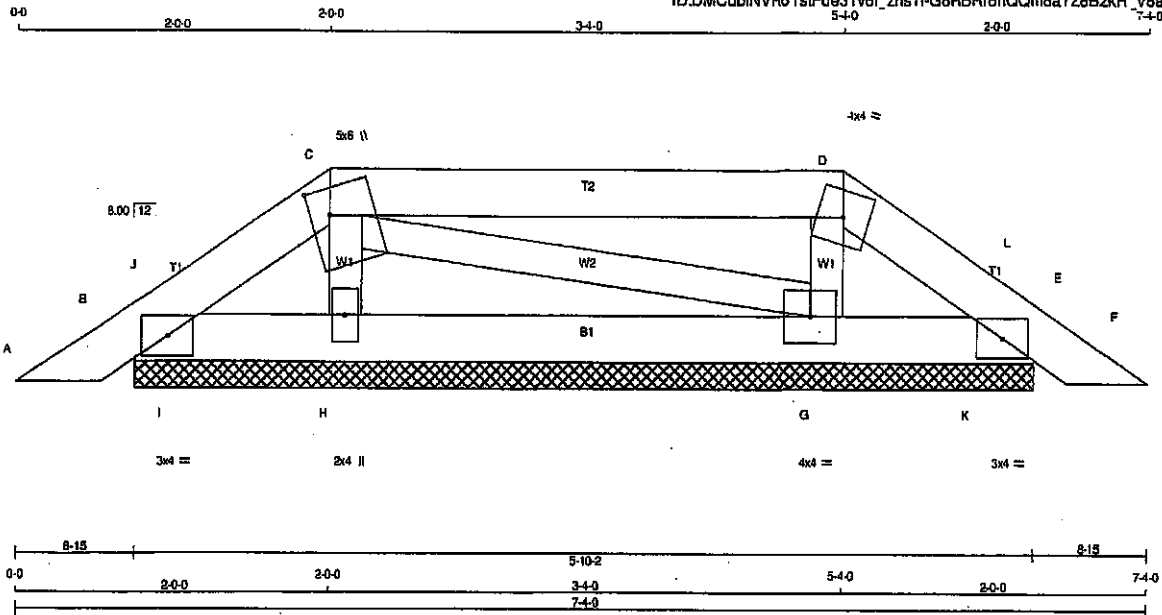

TOTAL WEIGHT = 19 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER			
N.L.G.A. RULES				BEARINGS			
CHORDS	SIZE	LUMBER	DESCR.	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
A - C	2x4	DRY	No.2	GROSS REACTION	GROSS REACTION	BRG	BRG
C - D	2x4	DRY	No.2	DOWN	DOWN	IN-SX	IN-SX
D - F	2x4	DRY	No.2	UP	UP	5-10-2	5-10-2
B - E	2x4	DRY	No.2	UP	UP	5-10-2	5-10-2
ALL WEBS 2x3 DRY				UNFACTORED REACTIONS			
DRY: SEASONED LUMBER.				1ST LCASE	MAX. MIN. COMPONENT REACTIONS		
				JT	COMBINED	SNOW	LIVE
				B	102	81/0	0/0
				E	99	78/0	0/0
				H	168	101/0	0/0
				G	172	108/0	0/0

PLATES (tablets in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMB1-I	MT20	3.0	4.0
C	TTWW+m	MT20	5.0	8.0
D	TTWW-m	MT20	4.0	4.0
E	TMB1-I	MT20	3.0	4.0
G	BMWW1-I	MT20	4.0	4.0
H	BMWW1-w	MT20	2.0	4.0

UNFACTORED REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
B	102	81/0	0/0	0/0	0/0	21/0	0/0
E	99	78/0	0/0	0/0	0/0	21/0	0/0
H	168	101/0	0/0	0/0	0/0	65/0	0/0
G	172	108/0	0/0	0/0	0/0	66/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO				FR-TO			
A-B	0/15	-91.8	-91.8 0.03 (1)	H-C	-169/0	0.02 (1)	
B-J	-45/0	-91.8	-91.8 0.00 (4)	C-G	-7/0	0.00 (1)	
J-C	-48/0	-91.8	-91.8 0.01 (1)	G-D	-175/0	0.02 (1)	
C-D	-11/0	-91.8	-91.8 0.17 (1)	I-J	-58/0	0.00 (1)	
D-L	-38/0	-91.8	-91.8 0.01 (1)	K-L	-59/0	0.00 (1)	
L-E	-37/0	-91.8	-91.8 0.00 (4)				
E-F	0/15	-91.8	-91.8 0.03 (1)				
B-I	0/37	-18.5	-18.5 0.02 (1)				
I-H	0/37	-18.5	-18.5 0.03 (4)				
H-G	0/18	-18.5	-18.5 0.03 (4)				
G-K	0/31	-18.5	-18.5 0.03 (4)				
K-E	0/31	-18.5	-18.5 0.02 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS1: TC=0.17/1.00 (C-D:1), BC=0.03/1.00 (H-I:4), WB=0.02/1.00 (D-G:1), SS=0.12/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 518 354 1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.12 (D) (INPUT = 0.90)
JSI METAL= 0.04 (H) (INPUT = 1.00)




Structural component only
DWG# T-2007999

JOB NAME 408315	TRUSS NAME P82	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tagarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 09:31:24 2020 Page 1
ID:DMCubINVR6TsIFoe31v6l_zns1HkK?ZIB9JBku?Cd8KkgFgWhin1Q7p9Q?pxcBtuzLafH

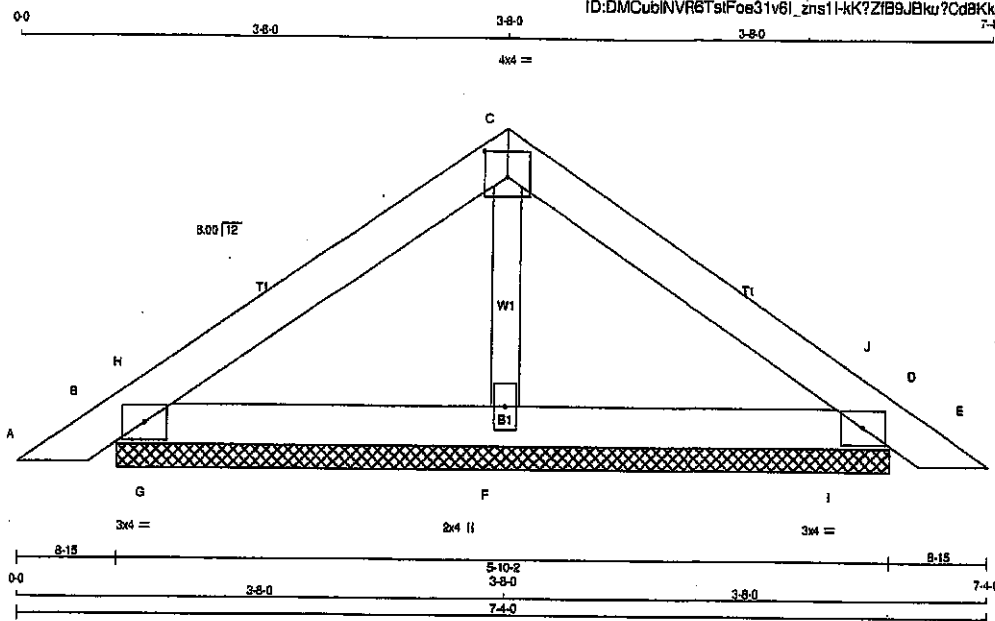

Scale = 1:15.6

TOTAL WEIGHT = 4 X 18 = 72 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
B - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	W	LEN	Y	X
BT TYPE PLATES				
B TMB1-I	MT20	3.0	4.0	
C TTW-p	MT20	4.0	4.0	2.25 2.00
D TMB1-I	MT20	3.0	4.0	
F BMW1+V	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
FACTORED	GROSS REACTION	MAXIMUM FACTORED	INPUT	RECORD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
B	282	0	282	0	5-10-2
D	282	0	282	0	5-10-2
F	282	0	282	0	5-10-2

UNFACTORED REACTIONS					
1ST CASE	MAX/MIN	COMPONENT REACTIONS			
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
B	176	127 / 0	0 / 0	0 / 0	49 / 0
D	176	127 / 0	0 / 0	0 / 0	49 / 0
F	187	113 / 0	0 / 0	0 / 0	74 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED (PL)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED (PL)	MAX. FACTORED (PL)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 15	-91.8	-91.8 0.03 (1)	10.00	F-C	-128 / 0	0.02 (1)
B-H	-37 / 0	-91.8	-91.8 0.04 (1)	6.25	G-H	-219 / 0	0.08 (1)
H-C	-90 / 0	-91.8	-91.8 0.09 (1)	8.25	I-J	-219 / 0	0.00 (1)
C-J	-80 / 0	-91.8	-91.8 0.09 (1)	6.25			
J-D	-37 / 0	-91.8	-91.8 0.04 (1)	6.25			
D-E	0 / 15	-91.8	-91.8 0.03 (1)	10.00			
B-G	0 / 71	-18.5	-18.5 0.10 (1)	10.00			
G-F	0 / 71	-18.5	-18.5 0.10 (1)	10.00			
F-I	0 / 71	-18.5	-18.5 0.10 (1)	10.00			
I-D	0 / 71	-18.5	-18.5 0.10 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.09/1.00 (C-H:1), BC=0.10/1.00 (B-G:1), WB=0.02/1.00 (C-F:1), SSI=0.18/1.00 (B-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1657 788 1957 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.22 (D) (INPUT = 0.90)
JSI METAL= 0.95 (B) (INPUT = 1.00)



Structural component only
DWG# T-2008000

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	PB3	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:28 2020 Page 1
ID:DMCubINVR8TsFoe31v6l_zns1l-gj7J4sAZl8lRwHjs5H8b7m6Df7mH32lGF5HymzLafF

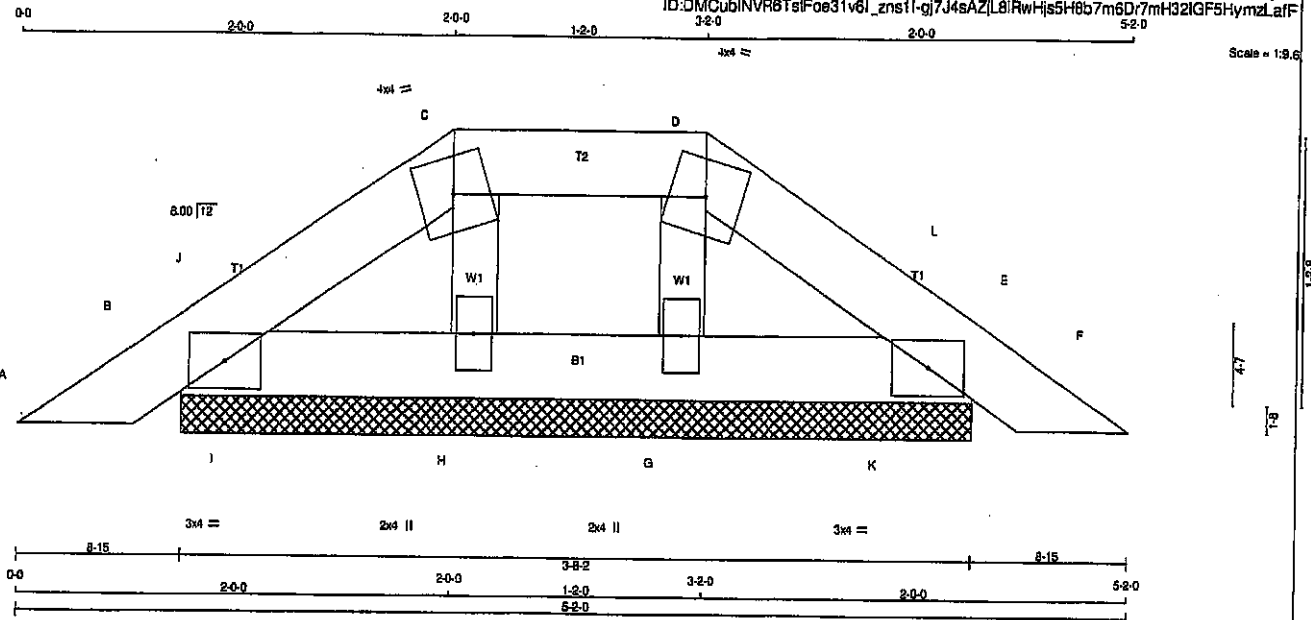

TOTAL WEIGHT = 12 lb (M)

LUMBER			
N.L.G.A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
B - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY, SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	GROSS REACTION	JT	GROSS REACTION	JT	GROSS REACTION	JT	GROSS REACTION
B	144	0	144	0	0	3-8-2	3-8-2
E	144	0	144	0	0	3-8-2	3-8-2
H	119	0	119	0	0	3-8-2	3-8-2
G	119	0	119	0	0	3-8-2	3-8-2

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND		DEAD		SOIL	
JT	COMBINED	JT	COMBINED	JT	COMBINED	JT	COMBINED	JT	COMBINED
B	101	74/0	0/0	0/0	0/0	27/0	0/0	0/0	0/0
E	101	74/0	0/0	0/0	0/0	27/0	0/0	0/0	0/0
H	85	54/0	0/0	0/0	0/0	31/0	0/0	0/0	0/0
G	85	54/0	0/0	0/0	0/0	31/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WIND		DEAD		SOIL	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. (LBS)	MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. (LBS)	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	FR-TO		FROM	TO	FR-TO	
A-B	0/15	-91.8	-91.8	0.03 (1)	10.00	H-C	-84/0	0.01 (1)	
B-J	-34/0	-91.8	-91.8	0.00 (4)	6.25	G-D	-84/0	0.01 (1)	
J-C	-27/0	-91.8	-91.8	0.02 (1)	6.25	I-J	-46/0	0.00 (1)	
C-D	-14/0	-91.8	-91.8	0.02 (1)	6.25	K-L	-46/0	0.00 (1)	
D-L	-27/0	-91.8	-91.8	0.02 (1)	6.25				
L-E	-34/0	-91.8	-91.8	0.00 (4)	6.25				
E-F	0/15	-91.8	-91.8	0.03 (1)	10.00				
B-I	0/23	-18.5	-18.5	0.02 (1)	10.00				
I-H	0/23	-18.5	-18.5	0.02 (1)	10.00				
H-G	0/14	-18.5	-18.5	0.01 (1)	10.00				
G-K	0/23	-18.5	-18.5	0.02 (1)	10.00				
K-E	0/23	-18.5	-18.5	0.02 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.03/1.00 (A-B:1), EC=0.02/1.00 (E-K:1), WB=0.01/1.00 (D-G:1), SS=0.04/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(CRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.11 (E) (INPUT = 0.90)
JSI METAL = 0.02 (B) (INPUT = 1.00)

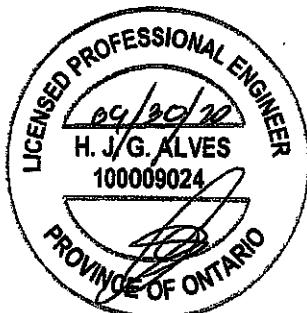

Structural component only
DWG# T-2008001

JOB NAME 408315	TRUSS NAME PB4	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 26 2019 MTEK Industries, Inc. Thu Apr 30 09:31:27 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-8vniHCBBUIGZ34gyQcoN8LJHvTh0WHRVmrUCzLafE

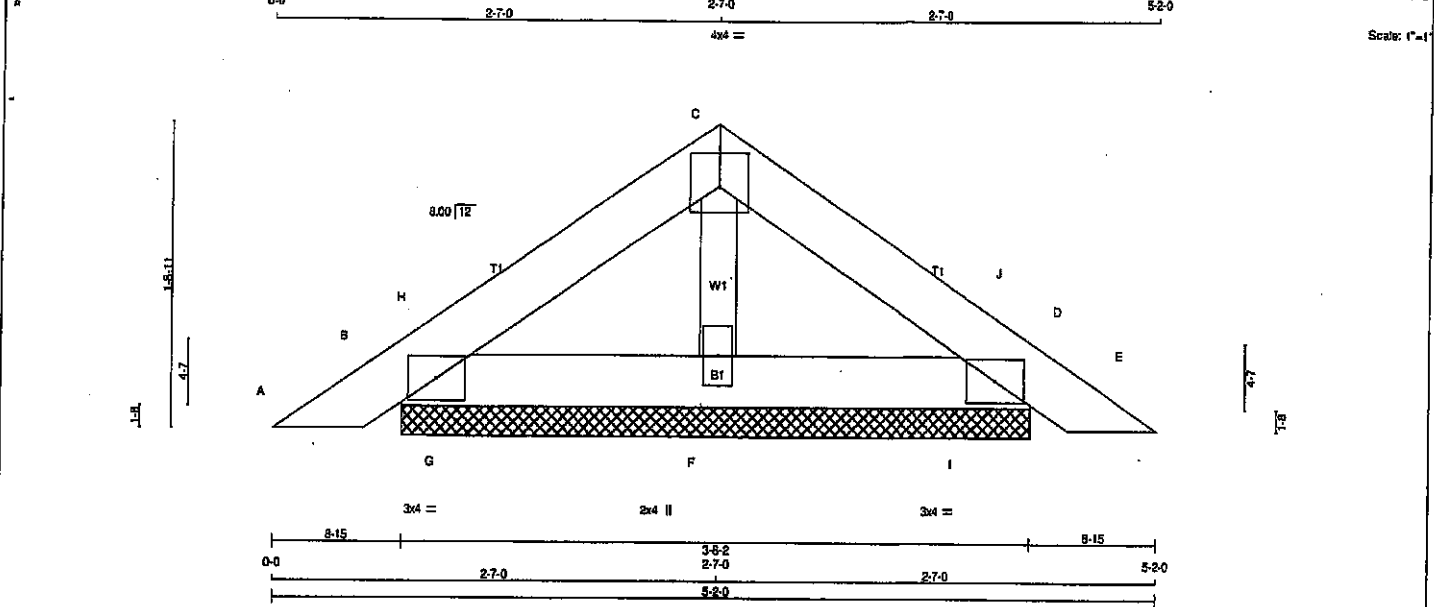

TOTAL WEIGHT = 2 X 12 = 24 lb

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	SPF	
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
B - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMB1-I	MT20	3.0	4.0	
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TMB1-I	MT20	3.0	4.0	
F	BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
B	175	0	175	0	0	3-8-2	3-8-2
D	175	0	175	0	0	3-8-2	3-8-2
F	178	0	178	0	0	3-8-2	3-8-2

UNFACTORED REACTIONS		MAX./MIN. COMPONENT REACTIONS						
	1ST CASE	COMBINED	SNOW	LIVE	PERM/LIVE	WIND	DEAD	SOIL
JT	122	89/0	0/0	0/0	0/0	0/0	33/0	0/0
B	122	89/0	0/0	0/0	0/0	0/0	33/0	0/0
D	127	78/0	0/0	0/0	0/0	0/0	49/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)		
FR-TO		FROM	TO		FR-TO				
A-B	0 / 15	-91.8	-91.8	0.03 (1)	10.00	F-C	-86 / 0	0.01 (1)	
B-H	-35 / 0	-91.8	-91.8	0.01 (1)	5.25	G-H	-99 / 0	0.00 (1)	
H-C	-45 / 0	-91.8	-91.8	0.03 (1)	5.25	I-J	-99 / 0	0.00 (1)	
C-J	-45 / 0	-91.8	-91.8	0.03 (1)	5.25				
J-D	-35 / 0	-91.8	-91.8	0.01 (1)	5.25				
D-E	0 / 15	-91.8	-91.8	0.03 (1)	10.00				
B-G	0 / 36	-18.5	-18.5	0.04 (1)	10.00				
G-F	0 / 36	-18.5	-18.5	0.04 (1)	10.00				
F-I	0 / 36	-18.5	-18.5	0.04 (1)	10.00				
I-D	0 / 36	-18.5	-18.5	0.04 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.03/1.00 (C-J:1), BC=0.04/1.00 (F-I:1), WB=0.01/1.00 (C-F:1), SS=0.07/1.00 (D-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1657 798 1987 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.14 (D) (INPUT = 0.90)
JSI METAL = 0.03 (B) (INPUT = 1.00)



Structural component only
DWG# T-2008002

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	PB5	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.31D S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 09:31:29 2020 Page 1					
ID:DMCubINVR6TstFoe31v6I_znsf1-5HpSiwDS?GWHIOIXDqrDmOd628sUQkkyDKxZ5ZLaIC					
Scale = 1:13.8					

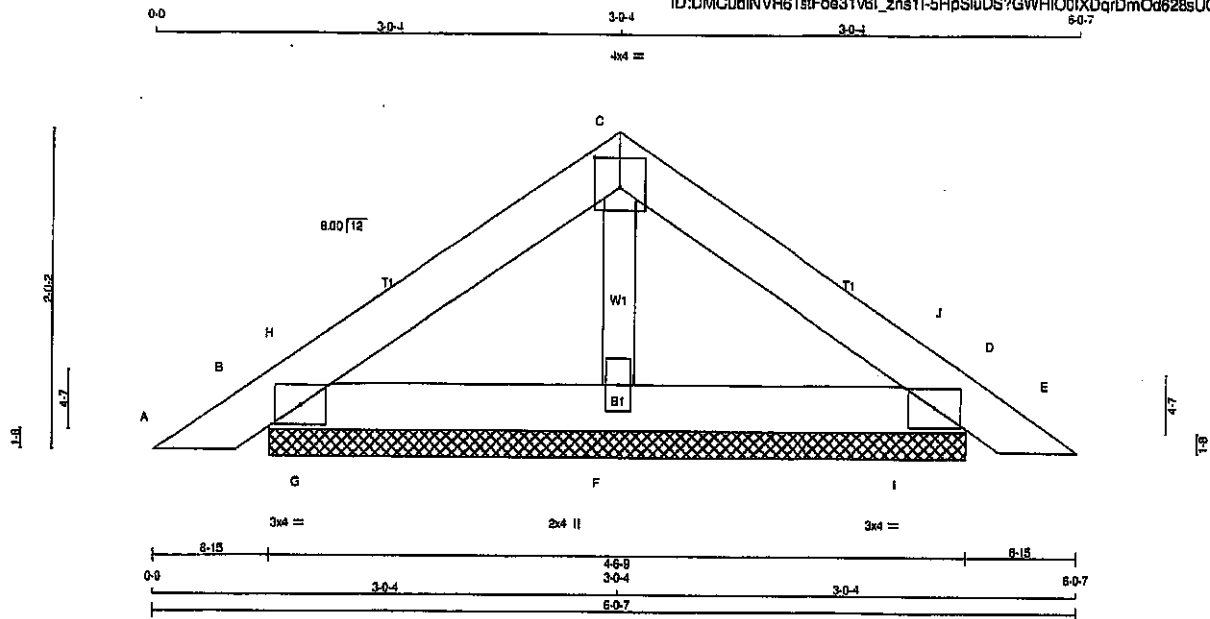

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
B - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMB1-I	MT20	3.0	4.0	
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TMB1-I	MT20	3.0	4.0	
F	BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORIZ	BRG	IN-SX	BRG	IN-SX
B	205	0	205	0	0	4-8-8	4-8-8	4-8-8	4-8-8
D	205	0	205	0	0	4-8-8	4-8-8	4-8-8	4-8-8
F	213	0	213	0	0	4-8-8	4-8-8	4-8-8	4-8-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	143	104 / 0	0 / 0	0 / 0	0 / 0	39 / 0	0 / 0
D	143	104 / 0	0 / 0	0 / 0	0 / 0	39 / 0	0 / 0
F	152	92 / 0	0 / 0	0 / 0	0 / 0	59 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD LO1 (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO				FR-TO			
A-B	0 / 15	-91.8	-91.8 0.03 (1)	10.00	F-C	-104 / 0	0.02 (1)
B-H	-38 / 0	-91.8	-91.8 0.02 (1)	6.25	G-H	-141 / 0	0.00 (1)
H-C	-62 / 0	-91.8	-91.8 0.05 (1)	8.25	I-J	-141 / 0	0.00 (1)
C-J	-62 / 0	-91.8	-91.8 0.05 (1)	8.25			
J-D	-38 / 0	-91.8	-91.8 0.02 (1)	8.25			
D-E	0 / 15	-91.8	-91.8 0.03 (1)	10.00			
B-G	0 / 49	-18.5	-18.5 0.08 (1)	10.00			
G-F	0 / 49	-18.5	-18.5 0.08 (1)	10.00			
F-I	0 / 49	-18.5	-18.5 0.08 (1)	10.00			
I-D	0 / 49	-18.5	-18.5 0.08 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.05/1.00 (C-H-1), BC=0.08/1.00 (B-G-1),
WB=0.02/1.00 (C-F-1), SI=0.10/1.00 (B-G-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.17 (B) (INPUT = 0.90)
JSI METAL = 0.04 (B) (INPUT = 1.00)

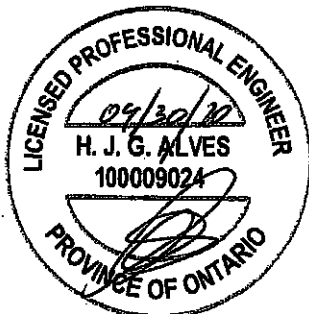

Structural component only
DWG# T-2008003

JOB NAME 408315	TRUSS NAME PB5Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:30 2020 Page 1
ID:DMCubINVR6TstF0e31v6I_znsf1-ZUMqWED4mae8wYbU5xM4mzxoGSUZD15IRt4V5XzLaR3
60-7

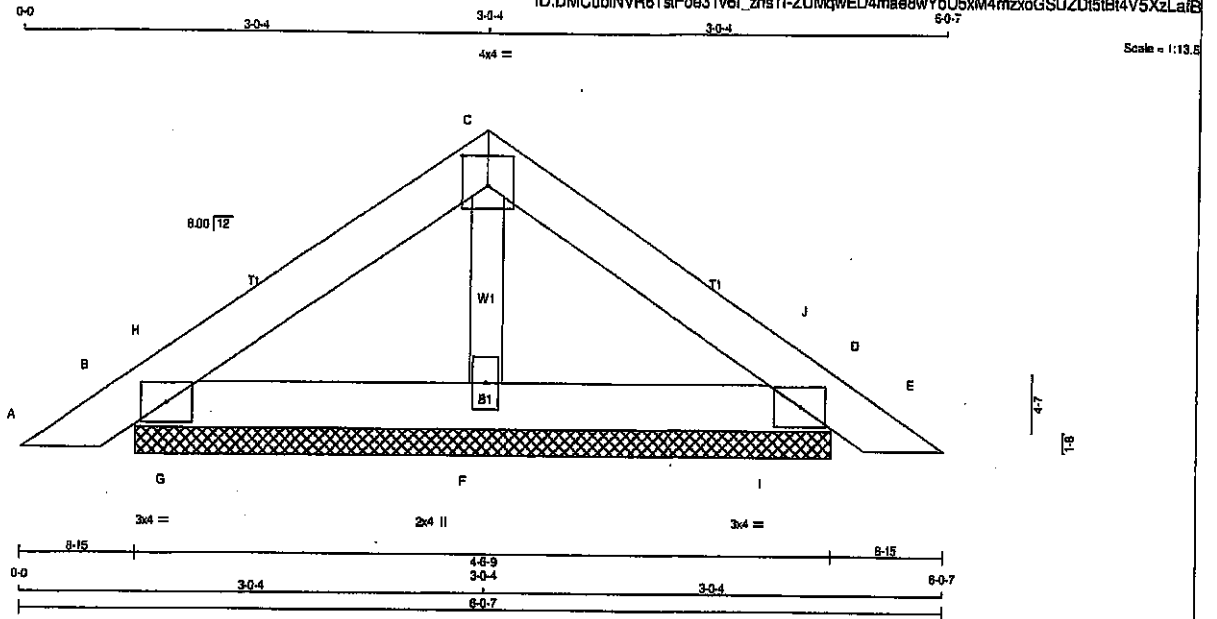

Scale = 1/16"

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
B - D	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE	LOAD(PLF)
SPACING (IN)		
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	TOP
C - E	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
B - D	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B - TM81-I	MT20	3.0	4.0	
C - TTW-p	MT20	4.0	4.0	2.25 2.00
D - TM81-I	MT20	3.0	4.0	
F - BMW1-w	MT20	2.0	4.0	

DIMENSIONAL SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		RECORD BRG	
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
B	208	0	208	0	0	0	4-8-9	4-8-9	
D	208	0	208	0	0	0	4-8-9	4-8-9	
F	212	0	212	0	0	0	4-8-9	4-8-9	

UNFACTORED REACTIONS						
JT	1ST CASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD
B	144	104/0	0/0	0/0	0/0	39/0
D	144	104/0	0/0	0/0	0/0	39/0
F	151	92/0	0/0	0/0	0/0	59/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO				FR-TO			
A-B	0/15	-91.8	-91.8 0.01 (1)	F-C	-104/0	0.01 (1)	
B-H	-40/0	-91.8	-91.8 0.01 (1)	G-H	-139/0	0.00 (1)	
H-C	-62/0	-91.8	-91.8 0.03 (1)	I-J	-139/0	0.03 (1)	
C-J	-62/0	-91.8	-91.8 0.03 (1)				
J-D	-40/0	-91.8	-91.8 0.01 (1)				
D-E	0/15	-91.8	-91.8 0.01 (1)				
B-G	0/49	-18.5	-18.5 0.03 (1)				
G-F	0/49	-18.5	-18.5 0.03 (1)				
F-I	0/49	-18.5	-18.5 0.03 (1)				
F-D	0/49	-18.5	-18.5 0.03 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.5 PSF
DL = 5.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.03/1.00 (C-H:1), BC=0.03/1.00 (B-G:1), WB=0.01/1.00 (C-F:1), SS=0.05/1.00 (B-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JST GRIP = 0.09 (B) (INPUT = 0.90)
JST METAL = 0.02 (B) (INPUT = 1.00)



Structural component only
DWG# T-2008004

JOB NAME 408315	TRUSS NAME J1	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

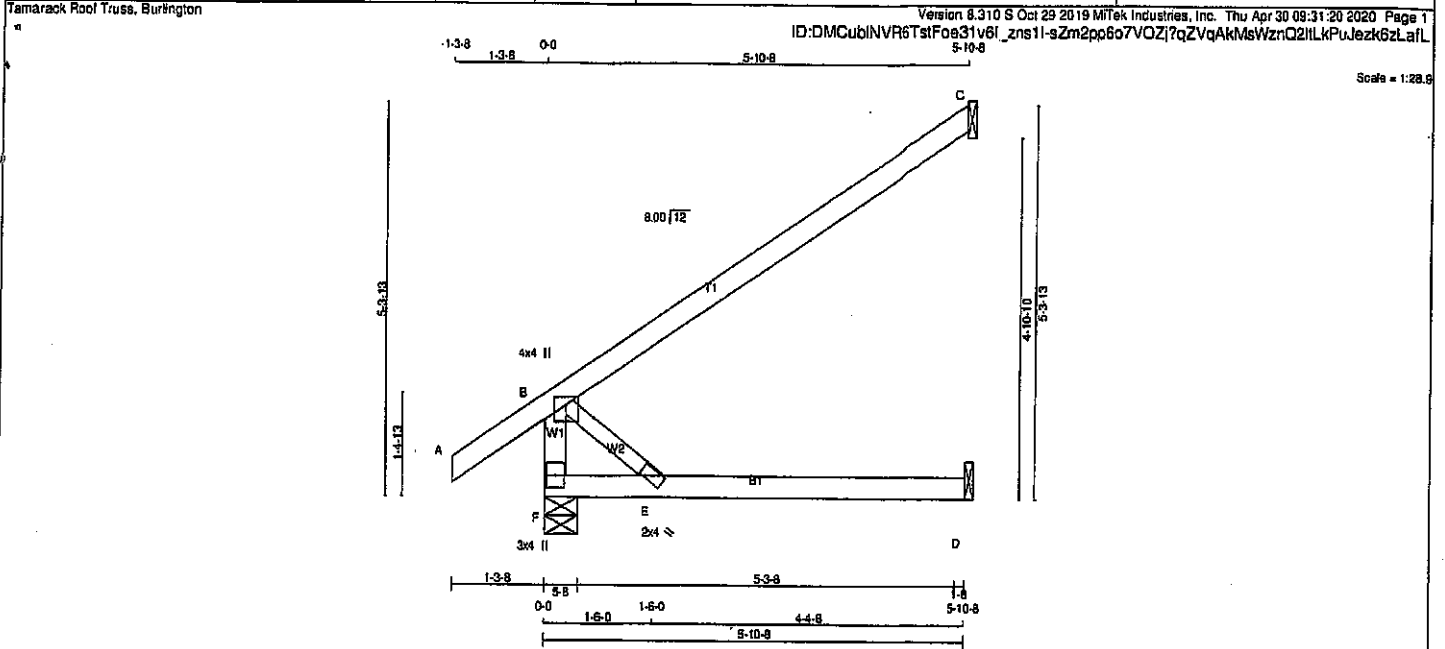

LUMBER				DESIGN CRITERIA			
N. L. G. A. RULES				SPECIFIED LOADS:			
CHORDS	SIZE	DRY	LUMBER	TOP CH. LL	=	25.6	PSF
F - B	2x4	DRY	No.2	DL	=	6.0	PSF
A - C	2x4	DRY	No.2	BOT CH. LL	=	0.0	PSF
F - D	2x4	DRY	No.2	DL	=	7.4	PSF
ALL WEBS	2x3	DRY	No.2	TOTAL LOAD	=	39.0	PSF
DRY: SEASONED LUMBER.				TOTAL WEIGHT = 6 X 19 = 115 lb			

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.25	2.00
E BMW+w	MT20	2.0	4.0		
F BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
	FACTORED		MAXIMUM FACTORED		INPUT		RECORD		
	GROSS REACTION		GROSS REACTION		BRG		BRG		
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
F	450	0	450	0	0	5-8	5-8		
C	270	0	270	0	0	1-8	1-8		
D	54	0	51	0	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	316	221 / 0	0 / 0	0 / 0	0 / 0	95 / 0	0 / 0
C	188	150 / 0	0 / 0	0 / 0	0 / 0	35 / 0	0 / 0
D	43	0 / 0	0 / 0	0 / 0	0 / 0	43 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO	UNBRAC LENGTH	FR-TO			
F-B	-385 / 0	0.0	0.0 0.04 (1)	8-E	0 / 0	0.00 (1)	
A-B	0 / 35	-91.8	-91.8 0.12 (1)				
B-C	0 / 0	-91.8	-91.8 0.54 (1)				
F-E	0 / 0	-18.5	-18.5 0.14 (4)				
E-D	0 / 0	-18.5	-18.5 0.19 (4)				

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.05")

CSI: TC=0.54/1.00 (B-C:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SSI=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1687

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.28 (B) (INPUT = 0.80)
JSI METAL= 0.08 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007997

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	J2	8	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:22 2020 Page 1					
ID:DMCubINVR6TstFoe31v6l_zns11-oxupEV737eHzJ_ydFCCRHCpDDICLFEId74p7zLafJ					
Scale = 1:10.4					

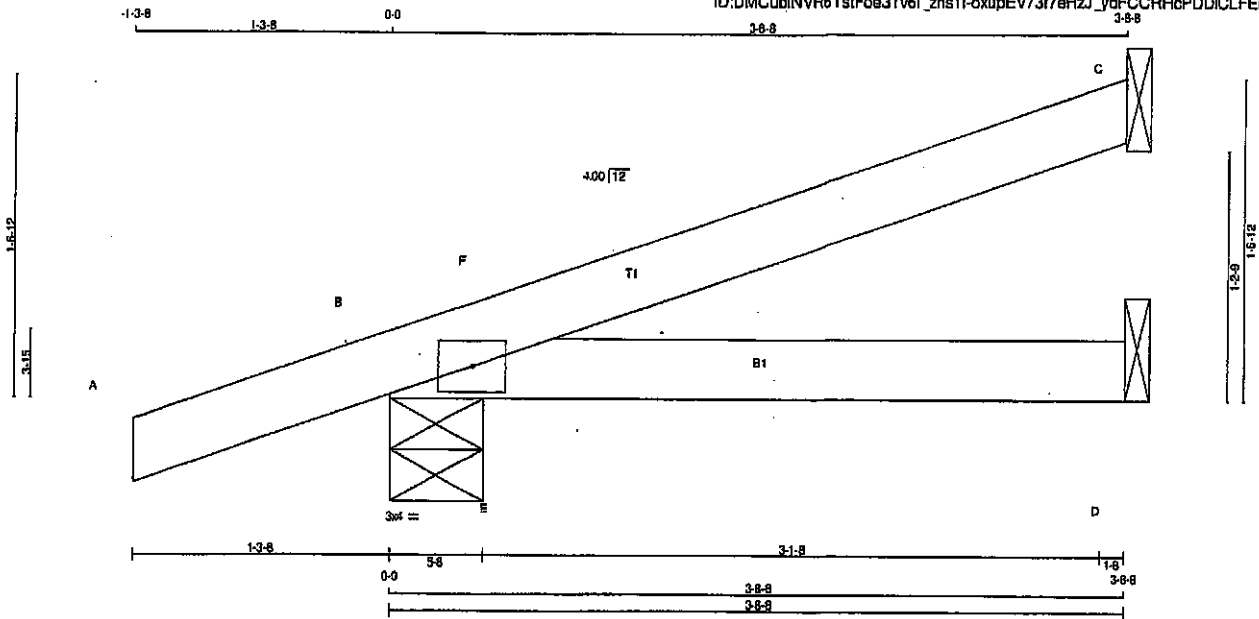

TOTAL WEIGHT = 8 X 10 = 83 lb

LUMBER	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES				
CHORDS	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
B - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UPLIFT
C	146	0	146	0
B	327	0	327	0
D	58	0	58	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS	1ST CASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED	SNOW
C	101	78 / 0
B	229	163 / 0
D	43	17 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. CSI (LC)
FR-TO				
A-B	0 / 18	-91.8	-91.8 0.13 (5)	10.00
B-F	-11 / 0	-91.8	-91.8 0.04 (4)	6.25
F-C	0 / 2	-91.8	-91.8 0.16 (1)	10.00
B-E	0 / 0	-18.5	-18.5 0.12 (1)	10.00
E-D	0 / 0	-18.5	-18.5 0.12 (1)	10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.01")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.02")

CSI: TC=0.16/1.00 (C-F:1), BC=0.12/1.00 (B-E:1),
WB=0.00/1.00 (E-F:1), SSI=0.12/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.21 (B) (INPUT = 0.90)
JSI METAL = 0.08 (B) (INPUT = 1.00)

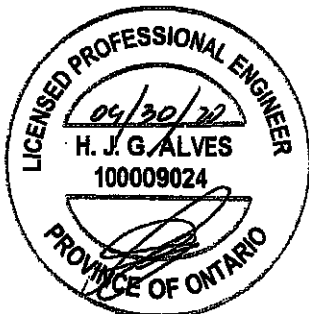


Structural component only
DWG# T-2007998

JOB NAME 408316	TRUSS NAME J30	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.310.5 Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:05:21 2020 Page 1
ID:DMCubINVR6TstFoe31v6f_zns11-bDddAio2TcXz4fMqZ_MaGYpB9fTbR?gDMZUJzLa9S

Scale = 1:24.6

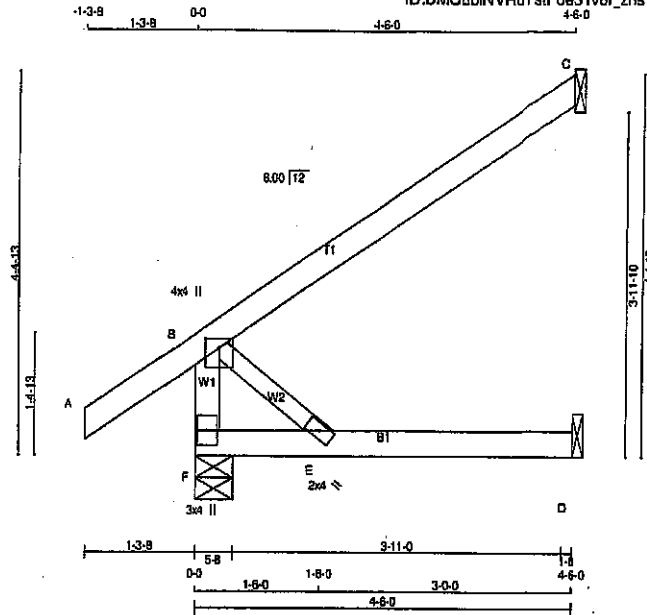

LUMBER				DESIGN CRITERIA			
N.L.G.A. RULES				SPECIFIED LOADS:			
CHORDS	SIZE	LUMBER	DESCR.	TOP CH.	LL	25.6	PSF
F-B	2x4	DRY	No.2	BOT CH.	LL	6.0	PSF
A-C	2x4	DRY	No.2		DL	0.0	PSF
F-D	2x4	DRY	No.2		DL	7.4	PSF
ALL WEBS	2x3	DRY	No.2	TOTAL LOAD		39.0	PSF
DRY: SEASONED LUMBER.				SPACING = 24.0 IN. OC			

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.25	2.00
E BMV+w	MT20	2.0	4.0		
F BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS				UNFACTORED REACTIONS			
FACTORED	MAXIMUM FACTORED	INPUT	REQD	1ST LCASE	SNOW	LIVE	PERM.LIVE
GROSS REACTION	GROSS REACTION	BRG	BRG	COMBINED	185 / 0	0 / 0	0 / 0
JT VERT	JT VERT	IN-SX	IN-SX				
F 374	F 374	5-8	5-8				
C 206	C 206	1-8	1-8				
D 42	D 42	1-8	1-8				

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	262	185 / 0	0 / 0	0 / 0	0 / 0	77 / 0	0 / 0
C	142	115 / 0	0 / 0	0 / 0	0 / 0	27 / 0	0 / 0
D	33	0 / 0	0 / 0	0 / 0	0 / 0	33 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
F-B	-332 / 0	0.0	0.03 (1)	B-E	0 / 0	0.00 (1)	
A-B	0 / 35	-91.8	-91.8 0.12 (1)				
B-C	0 / 0	-91.8	-91.8 0.32 (1)				
F-E	0 / 0	-18.5	-18.5 0.10 (4)				
E-D	0 / 0	-18.5	-18.5 0.11 (4)				

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.32/1.00 (B-C:1), BC=0.11/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRP(DRY)	SHEAR	SECTION
	(PS)	(PL)	(PL)
MT20	618	354	1667 788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.23 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)




Structural component only
DWG# T-2008026

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	C1	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:09 2020 Page 1
ID:DMCubINVR6TstF0e31v6l_zns1l-gRbuV2zv777vJUSM1T9PYZ9F_IBoN0oM6UurFzLatW

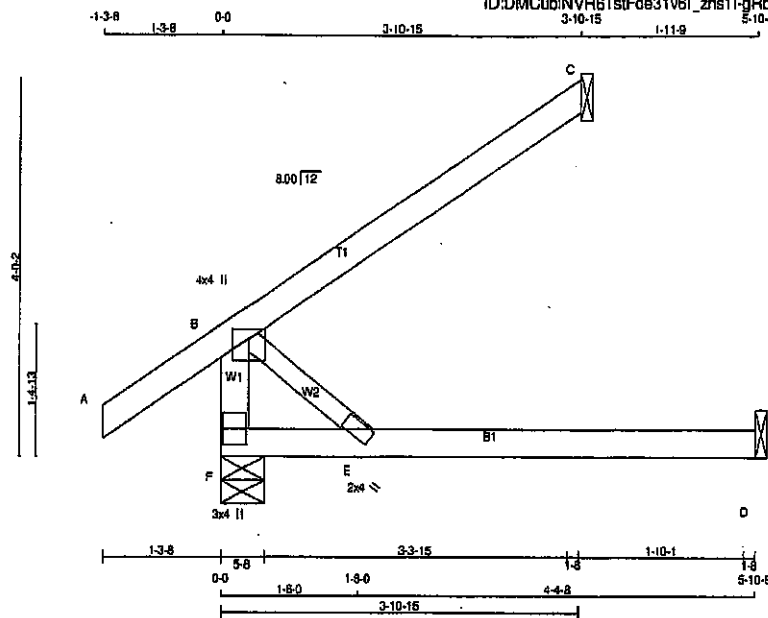

Scale = 1/22, 7

TOTAL WEIGHT = 17 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY, SEASONED LUMBER.			

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMW+w	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	UP	IN-SX
F	380	0	380	0	5-8
C	179	0	179	0	1-8
D	54	0	51	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
JT	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	254	170/0	0/0	0/0	0/0	83/0	0/0
C	124	100/0	0/0	0/0	0/0	23/0	0/0
D	43	0/0	0/0	0/0	0/0	43/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO		FR-TO			
F-B	-305/0	0.0	0.0 0.03 (1)	B-E	0/0	0.03 (1)	
A-B	0/35	-91.8	-91.8 0.12 (1)				
B-C	0/0	-91.8	-91.8 0.24 (1)				
F-E	0/0	-18.5	-18.5 0.14 (4)				
E-D	0/0	-18.5	-18.5 0.19 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(56 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/989$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/989$ (0.05")

CSI: TC=0.24/1.00 (B-C:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (B) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)

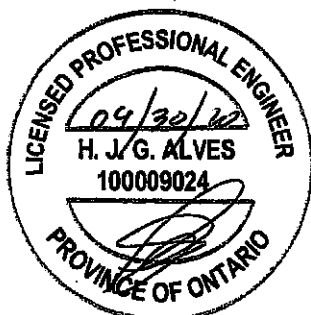

Structural component only
DWG# T-2007989

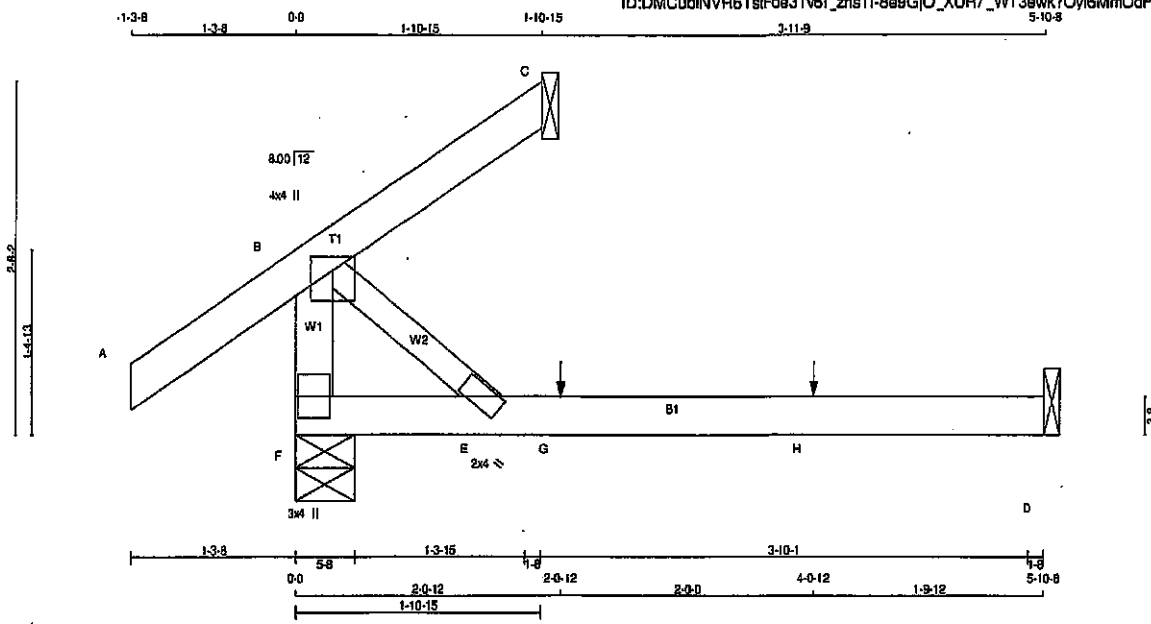

LUMBER					
N. L. G. A. RULES					
CHORDS	SIZE		LUMBER		DESCR
F - B	2x4	DRY	No.2		SPF
A - C	2x4	DRY	No.2		SPF
F - D	2x4	DRY	No.2		SPF
ALL WEBS	2x3	DRY	No.2		SPF
DRY: SEASONED LUMBER.					

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
E	BMVW+w	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT.	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
F	313	0	313	0	5-8	5-8
C	42	0	42	0	1-8	1-8
D	54	0	54	0	1-8	1-8

SEE MITEK STANDARD DETAIL 997791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
	1ST CASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	222	144/0	0/0	0/0	0/0	77/0	0/0
C	29	24/0	0/0	0/0	0/0	6/0	0/0
D	43	0/0	0/0	0/0	0/0	43/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO			FR-TO			
F-B	-259/0	0.0	0.0	0.03 (1)	7.81	B-E	0/0	0.00 (1)
A-B	0/35	-91.8	-91.8	0.13 (1)	10.00			
B-C	-25/0	-91.8	-91.8	0.12 (1)	6.25			
F-E	0/0	-18.5	-18.5	0.14 (4)	10.00			
E-G	0/0	-18.5	-18.5	0.19 (4)	10.00			
G-H	0/0	-18.5	-18.5	0.19 (4)	10.00			
H-D	0/0	-18.5	-18.5	0.19 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	2-0-12	1	1	---	FRONT	VERT	TOTAL	---	C1
H	4-0-12	1	1	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.05")

CSI: TC=0.13/1.00 (A-B:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.09/1.00 (B-C:1)

DOL LUMBER=0.98 NAIL=0.98 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES				
PLATE	GRIP(DRY)		SHEAR	SECTION
	(PSI)		(PLI)	(PLI)
	MAX	MIN	MAX	MIN
MT20	618	354	1667	788
			1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.18 (B) (INPUT = 0.80)
JSI METAL = 0.05 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007990

JOB NAME 408315	TRUSS NAME C3	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:12 2020 Page 1
ID:DMCubINVR6TstF0e31v6l_zr1s11-50H184?n02NimnD1191s1ABgUCLV?kE23iYSazLafT

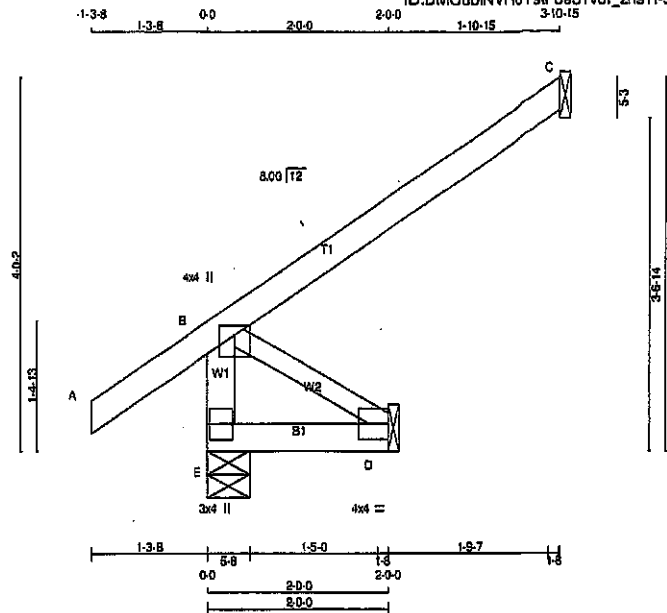

Scale = 1:23.0

TOTAL WEIGHT = 12 lb

LUMBER			
N.L.G.A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.25	2.00
D BMW1+1	MT20	4.0	4.0	2.00	Edge
E BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
E	323	0	323	0	0	5-8	5-8		
C	179	0	179	0	0	1-8	1-8		
D	18	0	20	0	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	224	170 / 0	0 / 0	0 / 0	0 / 0	54 / 0	0 / 0
C	124	100 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0
D	14	0 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX	CS1 (LC) UNBRAC	LENGTH	MEMB.	FORCE (LBS)	MAX	CS1 (LC)
FR-TO						FR-TO			
E-B	-305 / 0	0.0	0.0	0.03 (1)	7.81	E-D	0 / 0	0.00 (1)	
A-B	0 / 35	-91.8	-91.8	0.13 (5)	10.00				
B-C	0 / 0	-91.8	-91.8	0.24 (1)	10.00				
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	8.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-03, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00")

CSI: TC=0.24/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (B-D:1), SS=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1867 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.21 (B) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007991

JOB NAME 4Q8315	TRUSS NAME C4	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 5 Oct 2019 Mitek Industries, Inc. Thu Apr 30 09:31:13 2020 Page 1
ID:DMCubINVR6TslFoe31v6l_zns1H-ZCrPLQOPnMVZNwoDbsY5aOkt1bhkkB7NHjS5_0zLafS
1-10-15 2-0-0

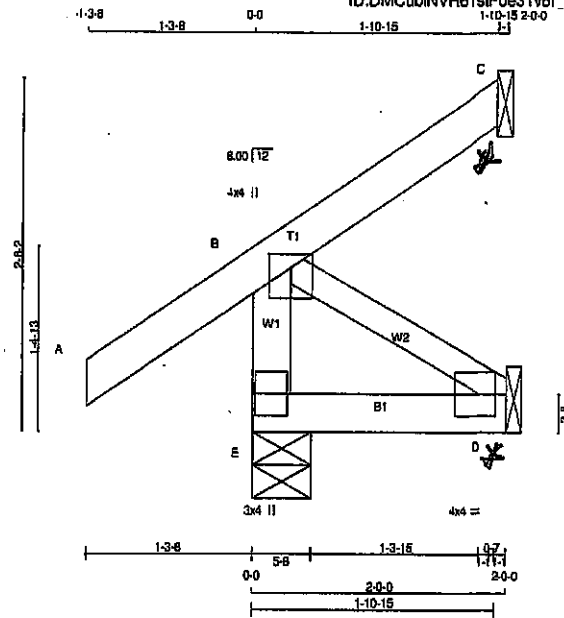

Scale = 1:16.2

LUMBER		CHORDS		SIZE	LUMBER	DESCR.	SPF
N. L. G. A. RULES		E - B		2x4	DRY	No.2	
		A - C		2x4	DRY	No.2	
		E - D		2x4	DRY	No.2	
ALL WEBS		2x3		DRY	No.2		
DRY: SEASONED LUMBER.							

PLATES (table is in inches)		JT TYPE	PLATES	W	LEN	Y	X
		B	TMVW+p	MT20	4.0	4.0	1.25 2.00
		D	BMW1-t	MT20	4.0	4.0	2.00 1.50
		E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
		GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
E	276	0	276	0	0
C	42	0	42	0	-35
D	18	0	20	0	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS		1ST CASE	MAX./MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
E	192	144 / 0	0 / 0	0 / 0	0 / 0	48 / 0
C	29	24 / 25	0 / 0	0 / 0	0 / 0	8 / 0
D	14	0 / 0	0 / 0	0 / 0	0 / 0	14 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS		MAX. FACTORED	FACTORED	W E B S	MAX. FACTORED
		FORCE	VERT. LOAD LC1	MAX.	MAX.
		(LBS)	(PLF)	CS1 (LC)	UNBRAC
			FROM TO	LENGTH	FR-TO
FR-TO					
E-B	-259 / 0	0.0	0.0	0.03 (1)	7.81
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00
B-C	-25 / 0	-91.8	-91.8	0.12 (1)	6.25
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CS1: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (B-D:1), SS=0.09/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1857 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007992

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408317	C50	4	1	GREEN PARK HOMES	

Taffarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:50:25 2020 Page 1
ID:DMCubNVR6TstF0e31v6l_zns11-QQzshIXAgPClUC4WztoSAUYxE9V8MPq72ZZnbzLZVC

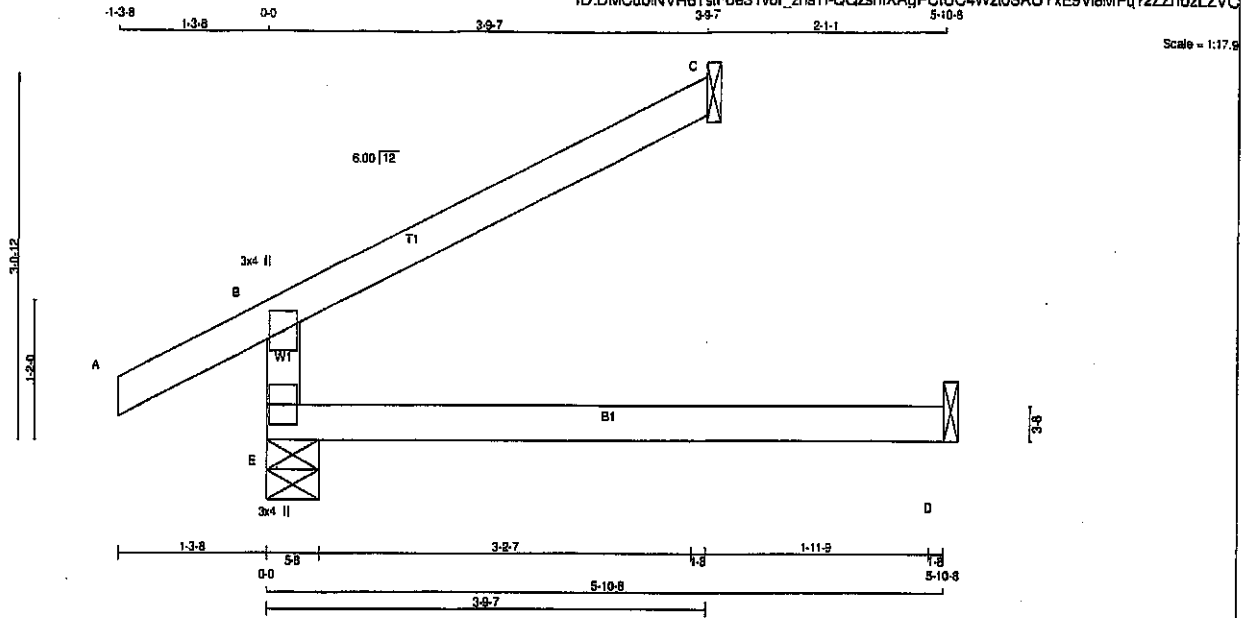

TOTAL WEIGHT = 4 X 14 = 57 lb (M)

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DESCR. SPF
SPF
SPF

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	405	0	405	0	0	5-8	5-8
C	130	0	130	0	0	1-8	1-8
D	45	0	50	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B87791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	288	180 / 0	0 / 0	0 / 0	0 / 0	96 / 0	0 / 0
C	90	73 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0
D	36	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LOAD LC1	MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM TO			FR-TO				
E-B	-342 / 0	0.0	0.0	0.13 (4)	7.81				
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00				
B-C	-19 / 0	-91.8	-91.8	0.22 (1)	6.25				
E-D	0 / 0	-18.5	-18.5	0.13 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.22/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 616 354 1587 788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.14 (E) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)

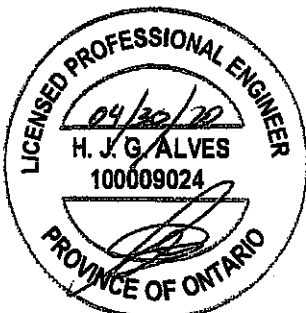

Structural component only
DWG# T-2008050

Structural component only
DWG# T-2008051

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408317	C52	4	1	GREEN PARK HOMES	
TAMERACK ROOF TRUSS, BURLINGTON				TRUSS DESC.	

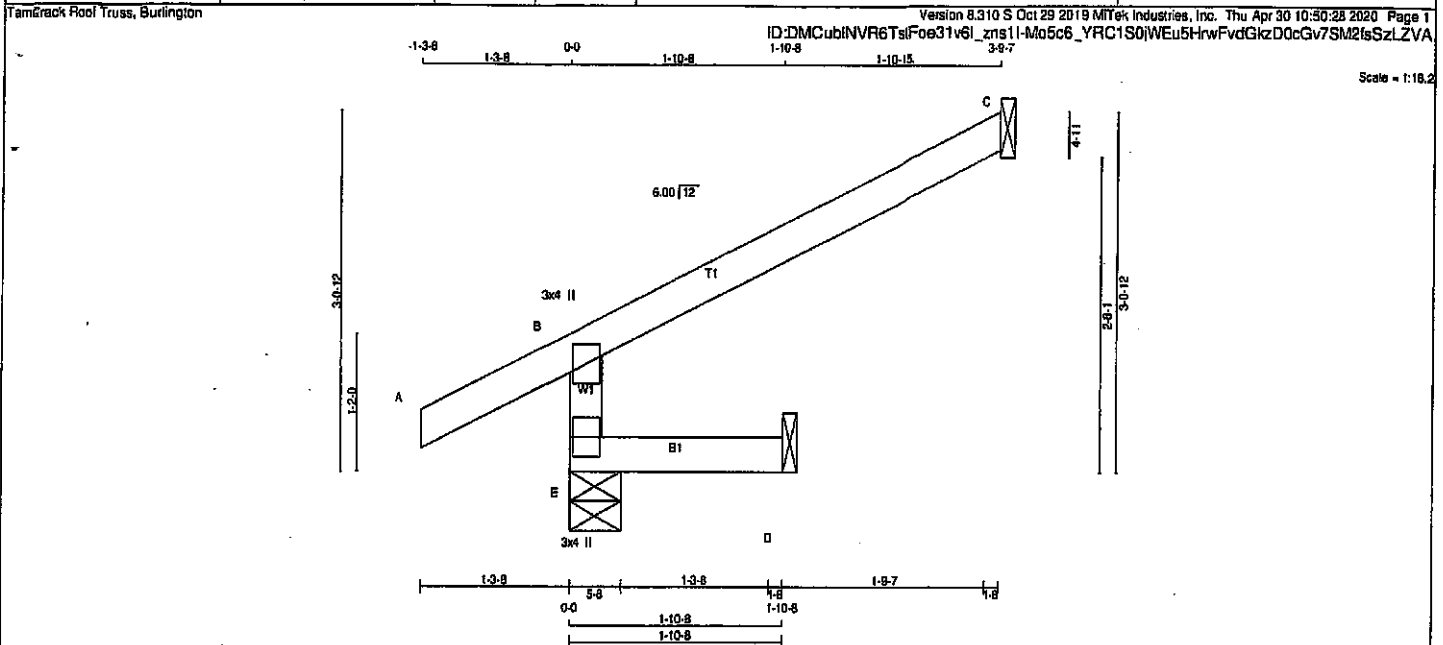


LUMBER				DESIGN CRITERIA			
N. L. G. A. RULES				TOTAL WEIGHT = 4 X 10 = 38 lb			
CHORDS	SIZE	LUMBER	DESCR.	SPECIFIED LOADS:			
E - B	2x4	DRY	No.2	TOP CH. LL = 25.6 PSF			
A - C	2x4	DRY	No.2	DL = 6.0 PSF			
E - D	2x4	DRY	No.2	BOT CH. LL = 0.0 PSF			
DRY: SEASONED LUMBER.				DL = 7.4 PSF			
				TOTAL LOAD = 39.0 PSF			

PLATES (table is in inches)				UNFACTORED REACTIONS			
JT	TYPE	PLATES	W	LEN	Y	X	
B	TMV-p	MT20	3.0	4.0			
E	BMV1+p	MT20	3.0	4.0			

BEARING				LOADING			
SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D				TOTAL LOAD CASES: (5)			
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E							
BRACING							
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.							
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.							
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.							

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX. MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO				FR-TO			
E-B	-342 / 0	0.0	0.0 0.01 (4)	7.81			
A-B	0 / 28	-91.8	-91.8 0.13 (5)	10.00			
B-C	-19 / 0	-91.8	-91.8 0.22 (1)	6.25			
E-D	0 / 0	-18.5	-18.5 0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

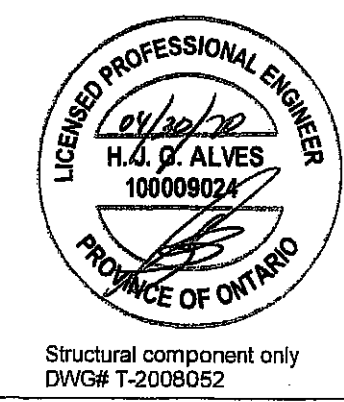

Structural component only
DWG# T-2008052

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1656
PLATE PLACEMENT TOL = 0.250 inches
PLATE ROTATION TOL = 5.0 Deg.
JSI GRIP = 0.14 (E) (INPUT = 0.30)
JSI METAL = 0.09 (B) (INPUT = 1.00)

LUL/LUS/LJS/HUS/HHUS/HGUS

SIMPSON
Strong-Tie

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.


Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options Information on p. 126.

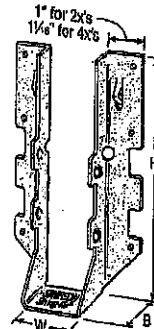


LUS28




LU26L



HUS210
(HUS26, HUS28,
and HHUS similar)



HGUS28-2



HHUS210-2



Double-Shear
Nailing
Top View





Double-Shear
Nailing
Side View;
Do not
bend tab



Dome Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,580

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

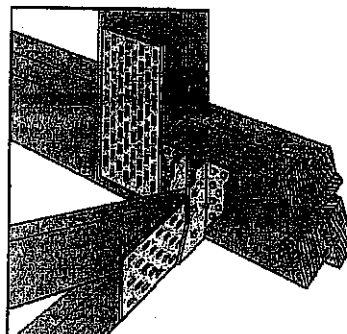

LJS26DS

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options Information on pp. 125–127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
$W < 2"$	Bevel or square cut	0.62 of table value	0.46 of table value
$2" < W < 6"$	Bevel cut	0.67 of table value	0.41 of table value
$2" < W < 6"$	Square cut	0.46 of table value	0.41 of table value
$W > 6"$	Bevel cut	0.75 of table value	0.41 of table value

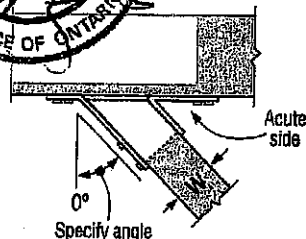

**Top View HHUS Hanger
Skewed Right**
(joist must be bevel cut)
All joist nails installed on the
outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _g ³	Header	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN	(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN
Single 2x Sizes											
LUS24	18	1 1/8	3 1/4	1 1/4	2 1/4	(4) 10d	(2) 10d	710 3.16	1625 7.23	645 2.87	1155 5.14
LU24L	22	1 1/8	3	1 1/4	2 1/4	(4) 10d	(2) 10d x 1 1/2"	360 1.60	1020 4.54	320 1.42	725 3.22
LU26L	22	1 1/8	5	1 1/4	4 1/4	(6) 10d	(4) 10d x 1 1/2"	720 3.20	1805 7.14	645 2.87	1140 5.07
LUS26	18	1 1/8	4 1/4	1 1/4	3 1/4	(4) 10d	(4) 10d	1420 6.32	2170 9.65	1290 5.74	1630 7.25
HUS26	16	1 1/8	5 1/4	3	3 1/4	(14) 16d	(6) 16d	2705 11.80	4940 21.97	2065 9.20	3875 17.24
LJS26DS	18	1 1/8	5	3 1/2	4 1/4	(16) 16d	(6) 16d	2055 9.14	4265 18.97	1460 6.49	4115 18.31
HGUS26	12	1 1/8	5 1/4	5	4 1/4	(20) 16d	(8) 16d	2685 11.96	6625 29.51	2685 11.96	5700 25.35
LU28L	20	1 1/8	6 1/4	1 1/4	5 1/4	(8) 10d	(6) 10d x 1 1/2"	1140 5.07	2185 9.72	1020 4.54	1550 6.89
LUS28	18	1 1/8	6 1/4	1 1/4	3 3/4	(6) 10d	(4) 10d	1420 6.32	2520 11.21	1290 5.74	1790 7.96
HUS28	16	1 1/8	7 1/4	3	6 1/4	(22) 16d	(8) 16d	3605 16.04	5365 23.86	2675 11.90	4345 19.33
HGUS28	12	1 1/8	7 1/4	5	6 1/4	(38) 16d	(12) 16d	3310 14.74	7675 34.19	3310 14.74	6900 30.73
LU210L	20	1 1/8	8	1 1/4	7 1/4	(10) 10d	(6) 10d x 1 1/2"	1140 5.07	2495 11.10	1020 4.54	1770 7.87
LUS210	18	1 1/8	7 1/4	1 1/4	3 3/4	(8) 10d	(4) 10d	1420 6.32	2785 12.39	1290 5.74	2210 9.83

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_g is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSON and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _c ³	Header	Joist	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb.	(K _D = 1.00) lb.	(K _D = 1.15) lb.	(K _D = 1.00) lb.
								kN	kN	kN	kN
Double 2x Sizes											
LUS24-2	18	3 1/8	3 1/8	2	1 1/2	(4) 16d	(2) 16d	835	2020	590	1435
LUS26-2	18	3 1/8	4 1/8	2	4	(4) 16d	(4) 16d	3.71	8.99	2.62	6.38
								1720	2595	1545	1920
HHUS26-2	14	3 1/8	5 1/8	3	3 15/16	(14) 16d	(6) 16d	7.65	11.54	6.87	8.54
								2850	7335	2065	5205
HGUS26-2	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	12.68	32.63	9.20	23.15
								4385	8950	3110	6355
LUS28-2	18	3 1/8	7	2	4	(6) 16d	(4) 16d	19.51	39.81	13.83	28.27
								1720	3325	1545	2575
HHUS28-2	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	7.65	14.79	6.87	11.45
								3765	8940	2675	6345
HGUS28-2	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	16.75	39.77	11.90	28.22
								6070	12980	4310	9215
LUS210-2	18	3 1/8	9	2	6	(8) 16d	(8) 16d	27.00	57.74	19.17	40.99
								2580	4500	2320	3195
HHUS210-2	14	3 1/8	9 1/8	3	8	(30) 16d	(10) 16d	11.48	20.02	10.32	14.21
								4670	9660	4235	7000
HGUS210-2	12	3 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	26.77	42.97	18.84	31.14
								6840	14015	4855	10270
								30.43	62.34	21.60	45.69
Triple 2x Sizes											
HGUS26-3	12	4 15/16	5 1/2	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-3	12	4 15/16	7 1/4	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-3	14	4 15/16	9	3	7 15/16	(30) 16d	(10) 16d	4670	9670	4235	6865
								20.77	43.02	18.84	30.54
HGUS210-3	12	4 15/16	9 1/4	4	8 1/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.26
Quadruple 2x Sizes											
HGUS26-4	12	6 1/8	5 3/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-4	12	6 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-4	14	6 1/8	8 1/8	3	7 15/16	(30) 16d	(10) 16d	4670	10155	4235	7210
								20.77	45.17	18.84	32.07
HGUS210-4	12	6 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.26
HGUS212-4	12	6 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	7640	14995	5425	10645
								33.98	66.70	24.13	47.35
HGUS214-4	12	6 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	61.80
4x Sizes											
LUS46	18	3 1/8	4 3/4	2	3 3/8	(4) 16d	(4) 16d	1720	2595	1545	1920
								7.65	11.54	6.87	8.54
HHUS46	14	3 1/8	5 1/4	3	3 15/16	(14) 16d	(6) 16d	2540	7335	2065	5205
								11.30	32.63	9.20	23.15
HGUS46	12	3 1/8	5 1/4	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
LUS48	18	3 1/8	6 1/8	2	3 3/8	(6) 16d	(4) 16d	1720	3325	1545	2575
								7.65	14.79	6.87	11.45
HHUS48	14	3 1/8	7 1/4	3	6 1/8	(22) 16d	(8) 16d	3765	8940	2675	6345
								16.75	39.77	11.90	28.22
HGUS48	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
LUS410	18	3 1/8	8 1/8	2	5 3/8	(8) 16d	(6) 16d	2580	4500	2320	3195
								11.48	20.02	10.32	14.21
HGUS410	12	3 1/8	9	4	8 3/8	(46) 16d	(16) 16d	6840	14015	4855	10270
								30.43	62.34	21.60	45.69
HGUS412	12	3 1/8	10 3/8	4	10 1/8	(56) 16d	(20) 16d	7640	14995	5425	10645
								33.98	66.70	24.13	47.35
HGUS414	12	3 1/8	12 3/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	61.80

SIMPSON
Strong-Tie

A circular professional engineer seal for the Province of Ontario. The outer ring contains the text "LICENSED PROFESSIONAL ENGINEER" at the top and "PROVINCE OF ONTARIO" at the bottom. In the center, the date "4/3/2017" is stamped in a small oval, the name "B. D. BUNTING" is printed in bold capital letters, and the license number "4032" is written in a large, stylized script across the bottom. A handwritten signature is also visible over the license number.

UNITED STATES
DEPARTMENT OF JUSTICE
FEDERAL BUREAU OF INVESTIGATION
WASHINGTON, D.C. 20535

Pratt & Whitney's 100th anniversary celebration
The Pratt & Whitney 100th anniversary celebration
Contact Simpson Strong-Tie for more information
© 2017 Simpson Strong-Tie Company, Inc.

PERG 97 17 9 11 11

(800) 999-5099
strongtie.com

H/TSP

SIMPSON
Strong-Tie

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_D = 1.15$)					
					D, Fir-L			S-P-F		
		To Rafters/Trusses	To Plates	To Studs	Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(8) 8d x 1½"	(4) 8d	—	740	685	300	680	485	215
					3.29	3.05	1.33	3.02	2.16	0.96
SS H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
					3.58	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	160	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	265	615	125	190
					3.29	0.80	1.18	2.74	0.56	0.85
H6	16	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	670	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS H8 ³	18	(5) 10d x 1½"	(5) 10d x 1½"	—	1120	—	—	1025	—	—
					4.98	—	—	4.56	—	—
SS H10A ³	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	585	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.54	1.36
H10A-2	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1835	1275	430	1645	880	305
					8.18	5.67	1.91	7.32	3.91	1.36
H10S ^{2,3}	18	(8) 8d x 1½"	(8) 8d x 1½"	(8) 8d	1465	795	315	1040	565	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2½"	(6) 16d x 2½"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	[1] (12) 8d x 1½"	(13) 8d	—	2390	855	320	1805	610	230
		[2] (12) 8d x 1½"	(15) 8d	—	10.63	3.80	1.42	8.03	2.71	1.02
					2390	855	320	1805	610	230
TSP	16	(9) 10d x 1½"	(6) 10d x 1½"	—	1295	440	—	920	310	—
					5.76	1.96	—	4.09	1.38	—
		(9) 10d x 1½"	(6) 10d	—	1560	440	—	1105	310	—
					6.94	1.96	—	4.92	1.38	—

- Factored resistances have been increased 15% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 595 lb. (2.65 kN) for D, Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTIECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D, Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 6/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D, Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1½" nails into the top plates and (3) 8d x 1½" nails into the lowest three flange holes into the truss bottom chord is 485 lb. (2.20 kN).
- Nails: 16d x 2½" = 0.162" dia. x 2½" long, 10d = 0.148" dia. x 3" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long, 8d x 1½" = 0.131" dia. x 1½" long. See pp. 27–28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

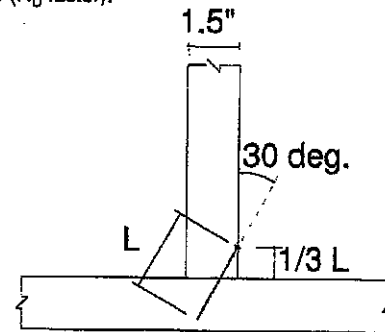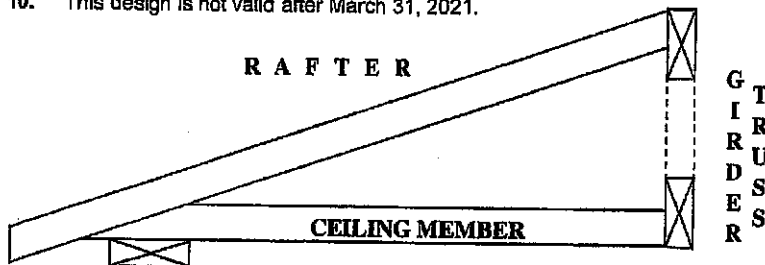


TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind** or **earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

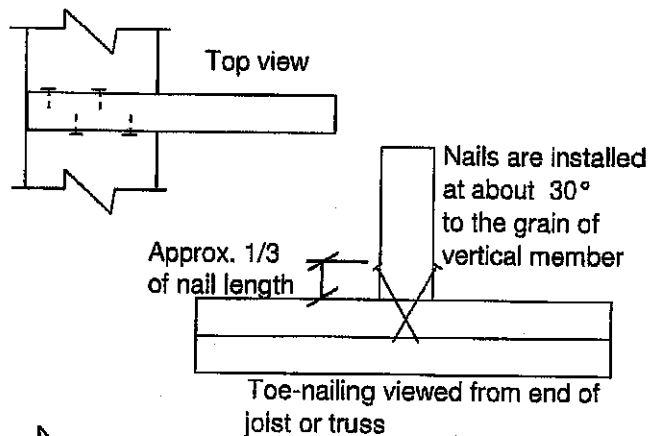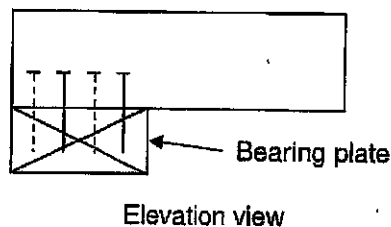

Toe-nailing on 2x4 Bearing Plate

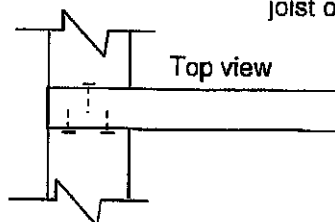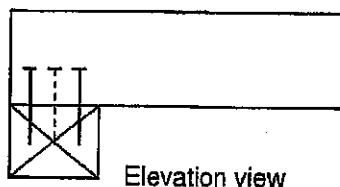

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7


PEO
Certificate No. 10889485




December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/4" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.

Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

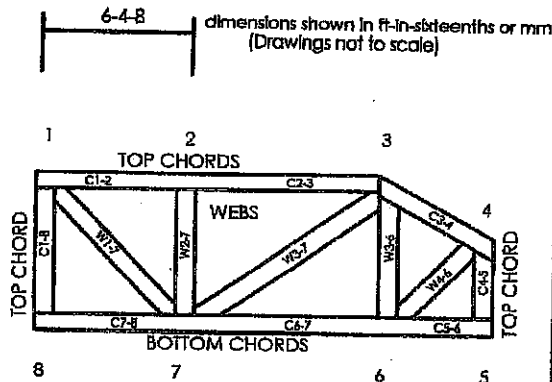

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MH-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

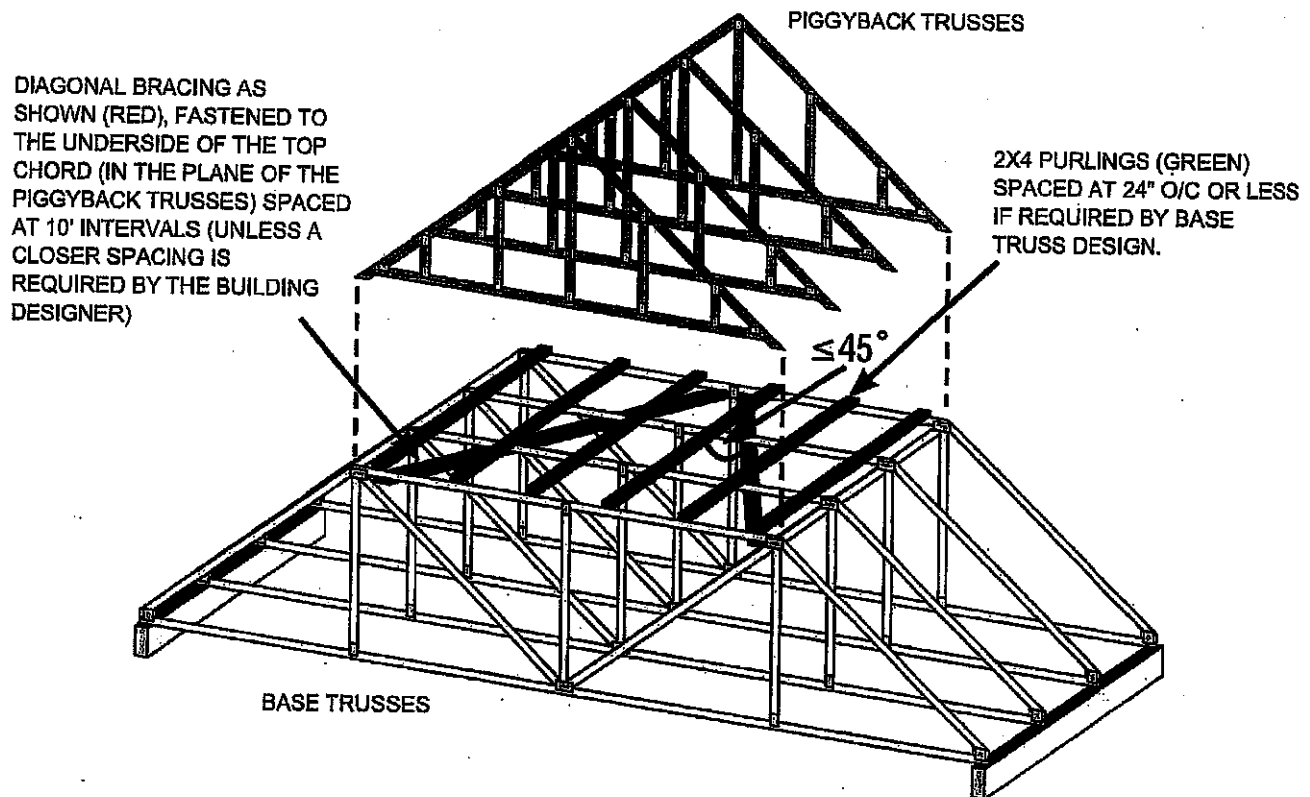

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1300213

Feb 09, 2018