


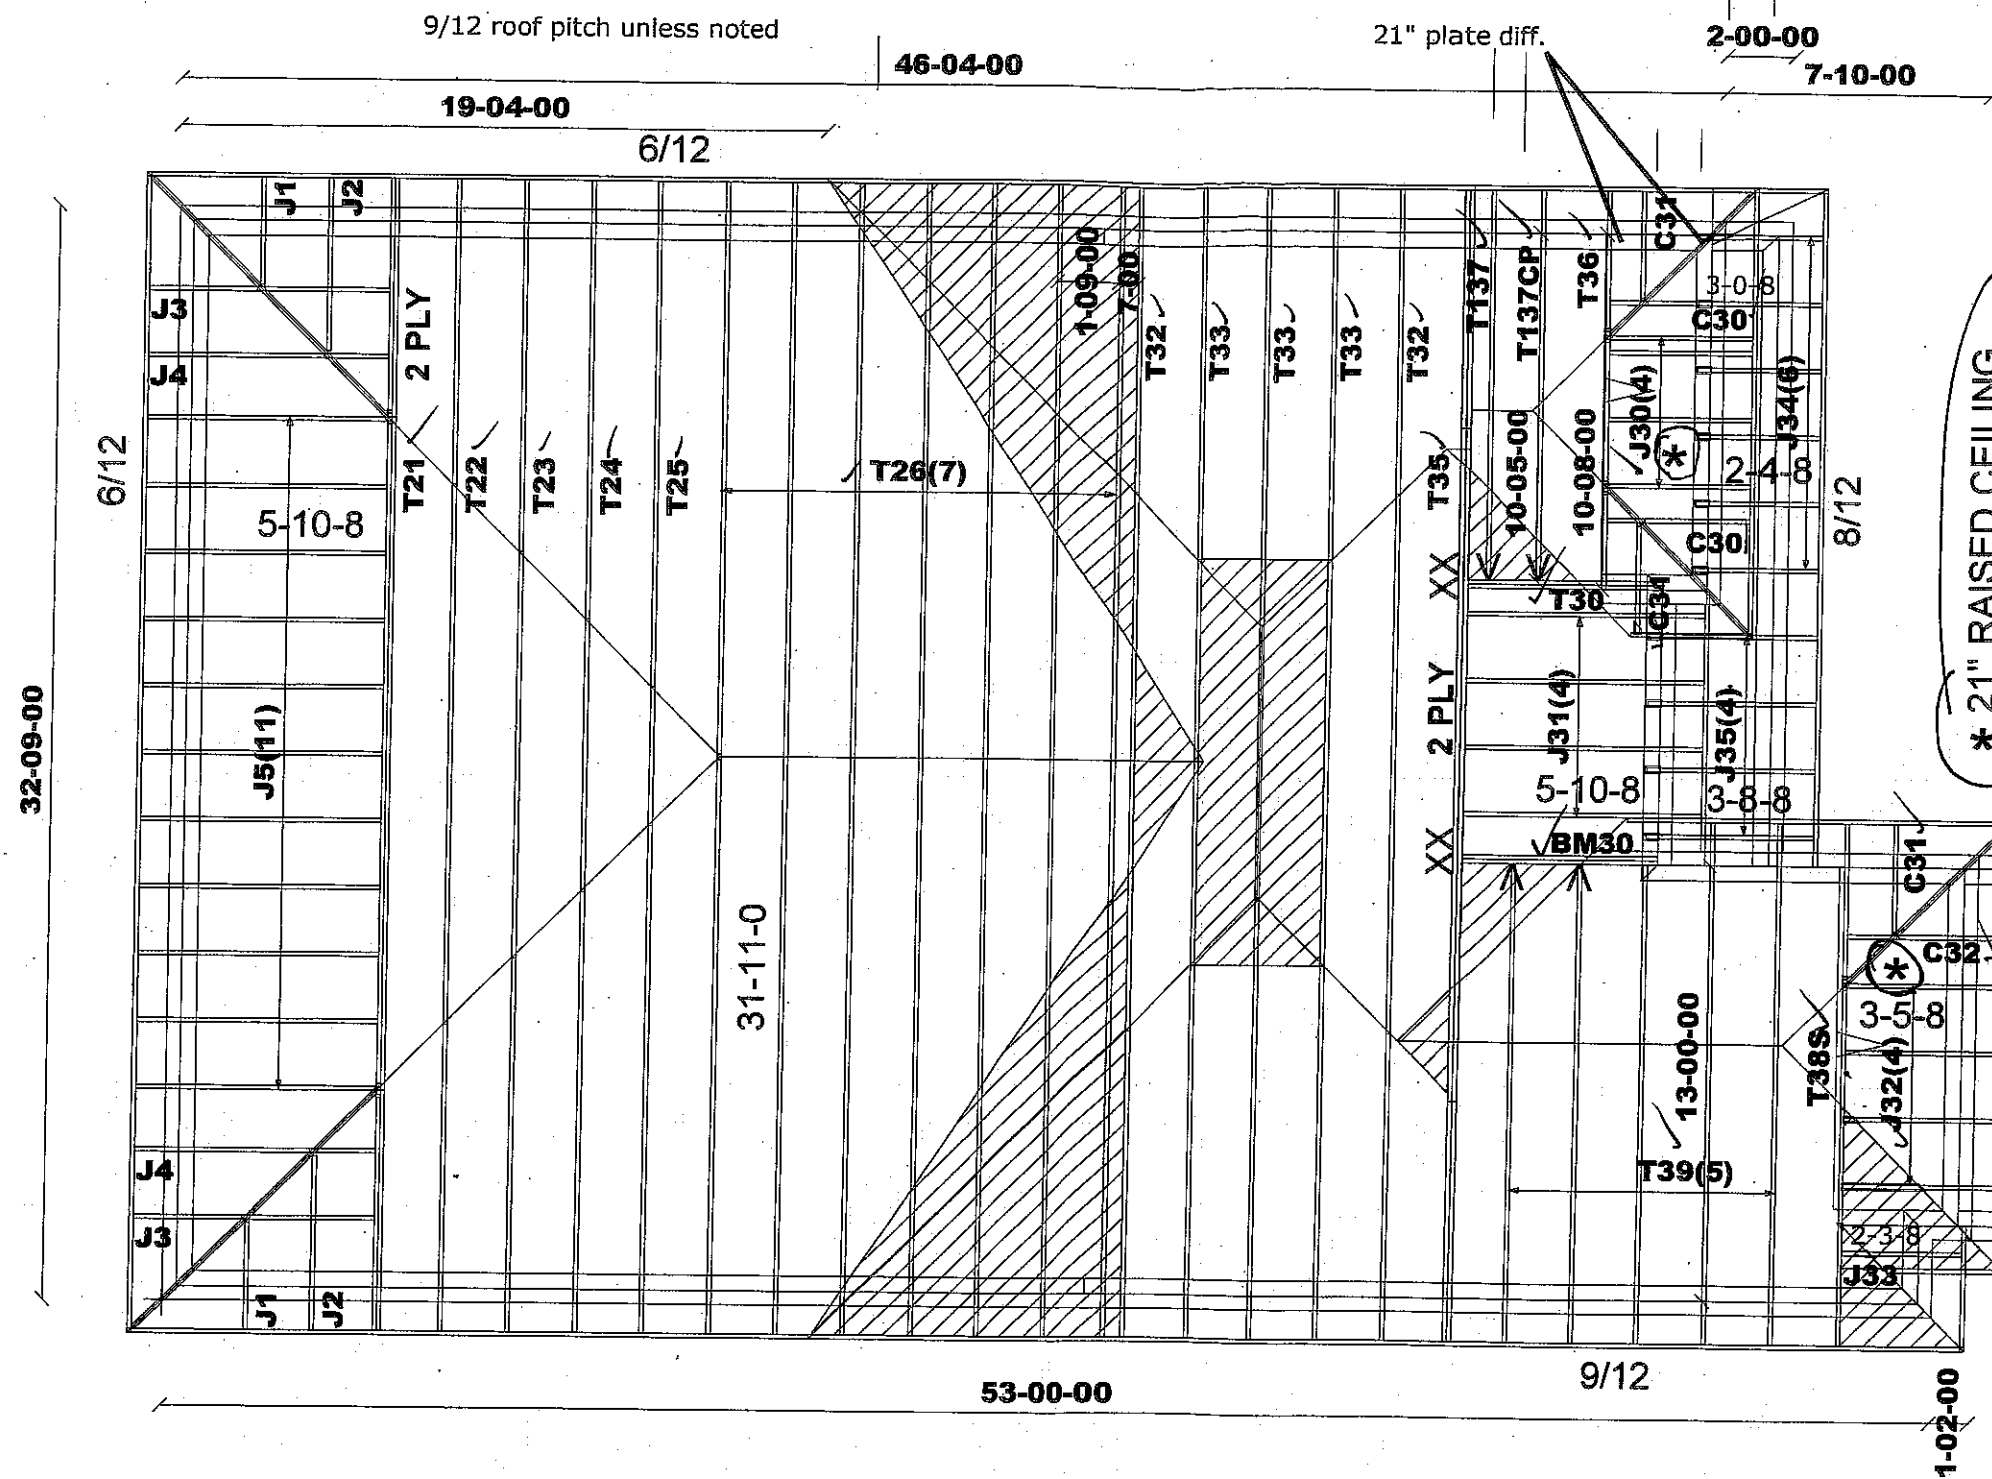

CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department
NOV 28 2021
REC BY _____ DATE _____
REF'D TO _____ DATE _____

CITY OF HAMILTON
Building Division
Permit No. 21-163000
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by
APR 08 2022
FOR JPL

ASPHALT SHINGLES
12" FINISHED OH.
R.T.M.C.
2X6 EXTERIOR WALLS
2X6 FASCIA BOARD

HARDWARE:
LJS26DS - (V)
HGUS26-2 - (XX)

DENOTES
CONV.
FRAMING

BM30 = 2-2X10

DESIGN CONFORMS
WITH O.B.C.2012 PART 9
(2019 AMENDMENT)
DESIGN LOADS:
SNOW LOAD 25.6 PSF
TC DEAD 6 PSF
BC LIVE 0 PSF
BC DEAD 7.4 PSF

 M13754	Job Track: 51225	Builder / Location: GREEN PARK HOMES / WATERDOWN	Model / Elevation: VALLEYCREEK 5A/EL.2 LOT 553	Mitek ver 8.4.2.286
	Plan Log: 202410	Project: RUSSELL GARDENS PH.3		
	Layout ID: 421225	Date: 2021-08-25	Sales: Mario DiCano	Designer: ACJ
	THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.			




DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.4
 Location: WATERDOWN
 Model: VALLEYCREEK 5A
 Lot #:
 Elevation: 1

Job Track: 51225
 PlanLog: 202410
 Layout ID: 408187
 Ref #
 Page: 1 of 2
 Date: 04-20-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Common Girder	6/12	31-11-00	9-01-12	2 x 6		1-02-00 1-02-00	405.7 245.33		
	15	T2 Piggyback Base	9/12	19-06-00	8-00-00	2 x 4		1-06-04 5-09-04	1466.59 940.00		
	2	T2G GABLE	9/12	19-06-00	8-00-00	2 x 4	1-03-08	1-06-04 5-09-04	220.23 139.67		
	1 2-ply	T3 Common Girder	9/12	18-06-00	9-11-08	2 x 4 2 x 6	1-03-08 1-03-08	3-00-04 3-00-04	218.98 135.33		
	1	T4G GABLE	9/12	18-06-00	9-11-08	2 x 4	1-03-08 1-03-08	3-00-04 3-00-04	106.29 67.33		
	3	T5 Common	9/12	13-00-00	7-10-12	2 x 4 2 x 6	1-03-08 1-03-08	3-00-04 3-00-04	226.28 142.00		
	2	T5S Roof Special	9/12	13-00-00	7-10-12	2 x 4	1-03-08 1-03-08	3-00-04 3-00-04	147.33 94.67		
	1 2-ply	T21 Hip Girder	6/12	31-11-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	285.1 176.00		
	2	T22 Hip	6/12	31-11-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	259.03 161.67		
	2	T23 Hip	6/12	31-11-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	258.25 161.33		
	2	T24 Hip	6/12	31-11-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	271.21 168.33		
	2	T25 Hip	6/12	31-11-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	262.57 165.00		
	5	T26 Hip	6/12	31-11-00	9-01-12	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	646.18 404.17		
	15	PB1 Piggyback	9/12	7-10-11	2-11-08	2 x 4			306.92 192.50		

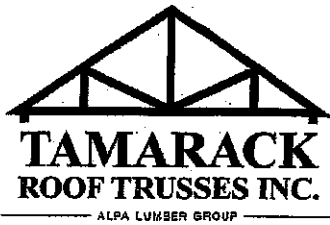

DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.4
 Location: WATERDOWN
 Model: VALLEYCREEK 5 A
 Lot #:
 Elevation: 1

Job Track: 51225
 PlanLog: 202410
 Layout ID: 408187
 Ref #
 Page: 2 of 2
 Date: 04-20-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	PB1G GABLE	9/12	7-10-11	2-11-08	2 x 4			43.38 27.67		
	2	J1 Jack-Open	6/12	1-10-15	2-01-08	2 x 4	1-03-08 1-01	1-02-00 2-01-08	14.65 9.33		
	2	J2 Jack-Open	6/12	2-00-00	3-01-08	2 x 4	1-03-08 1-10-15	1-02-00 2-02-00	19.75 12.00		
	2	J3 Jack-Open	6/12	1-10-15	2-01-08	2 x 4	1-03-08 3-11-09	1-02-00 2-01-08	23.48 14.67		
	2	J4 Jack-Open	6/12	3-10-15	3-01-08	2 x 4	1-03-08 1-11-09	1-02-00 3-01-08	28.58 17.33		
	11	J5 Jack-Open	6/12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	184.74 117.33		
	7	J6 Jack-Open	6/12	3-08-08	2-09-15	2 x 4	1-03-08	4-03 1-09-11	80.04 51.33		
	3	J7 Jack-Open	6/12	2-04-08	2-01-15	2 x 4	1-03-08	4-03 1-01-11	24.64 18.00		
	7	J8 Jack-Open	5/12	5-04-08	3-01-02	2 x 4	1-03-08	4-01 2-02-15	101.52 65.33		

TOTAL # TRUSS= 95

TOTAL BFT OF ALL TRUSSES= 3526.32

BFT.

TOTAL WEIGHT OF ALL TRSSES 5601.45 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
24	Hardware	LJS26DS	

TOTAL NUMBER OF
ITEMS= 24




DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH4
 Location: WATERDOWN
 Model: VALLEYCREEK 5A
 Lot #:
 Elevation: 2

Job Track: 51225
 PlanLog: 202410
 Layout ID: 408188
 Ref #
 Page: 1 of 3
 Date: 04-20-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T21 Hip Girder	6 /12	31-11-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	285.1 176.00		
	1	T22 Hip	6 /12	31-11-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	129.52 80.83		
	1	T23 Hip	6 /12	31-11-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	129.12 80.67		
	1	T24 Hip	6 /12	31-11-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	135.61 84.17		
	1	T25 Hip	6 /12	31-11-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	131.28 82.50		
	7	T26 Hip	6 /12	31-11-00	9-01-12	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	904.65 565.83		
	1 2-ply	T30 Flat Girder	0 /12	5-10-08	1-09-00	2 x 6		1-09-00 1-09-00	54.63 32.67		
	2	T32 Hip	9 /12	31-11-00	7-05-02	2 x 4	1-03-08 1-03-08	1-06-04 1-06-04	296.23 185.67		
	2	T33 Hip	9 /12	31-11-00	8-11-02	2 x 4	1-03-08 1-03-08	1-06-04 1-06-04	309.9 195.67		
	2	T34 Hip	9 /12	31-11-00	10-05-02	2 x 4	1-03-08 1-03-08	1-06-04 1-06-04	330.99 204.67		
	1 2-ply	T35 Hip Girder	9 /12	31-11-00	5-11-02	2 x 4 2 x 6	1-03-08 1-03-08	1-06-04 1-06-04	315.75 200.67		
	1	T36 Hip Girder	9 /12	10-08-00	3-09-10	2 x 4	1-03-08 1-03-08	1-06-04 1-06-04	49.02 32.33		
	1	T37 Common	9 /12	10-05-00	7-01-00	2 x 4	1-03-08 1-03-08	3-01-00 3-03-04	51.41 32.83		
	1	T37CP Hip	9 /12	10-05-00	6-10-06	2 x 4	1-03-08 1-03-08	3-01-00 3-03-04	53.15 34.00		

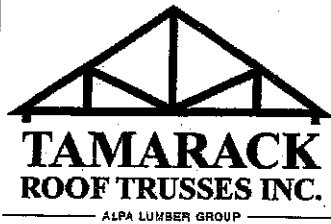

DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH4
 Location: WATERDOWN
 Model: VALLEYCREEK 5A
 Lot #:
 Elevation: 2

Job Track: 51225
 PlanLog: 202410
 Layout ID: 408188
 Ref #
 Page: 2 of 3
 Date: 04-20-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T38S Hip Girder	9 /12	13-00-00	5-10-06	2 x 4	1-03-08 1-03-08	1-06-04 1-06-04	61.59 41.50		
	5	T39 Common	9 /12	13-00-00	7-03-04	2 x 4	1-03-08 1-03-08	1-06-04 3-03-04	302.69 192.50		
	2	J1 Jack-Open	6 /12	1-10-15	2-01-08	2 x 4	1-03-08 1-01	1-02-00 2-01-08	14.65 9.33		
	2	J2 Jack-Open	6 /12	2-00-00	3-01-08	2 x 4	1-03-08 1-10-15	1-02-00 2-02-00	19.75 12.00		
	2	J3 Jack-Open	6 /12	1-10-15	2-01-08	2 x 4	1-03-08 3-11-09	1-02-00 2-01-08	23.48 14.67		
	2	J4 Jack-Open	6 /12	3-10-15	3-01-08	2 x 4	1-03-08 1-11-09	1-02-00 3-01-08	28.58 17.33		
	11	J5 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	184.74 117.33		
	4	J30 Jack-Open	9 /12	3-00-08	3-09-10	2 x 4	1-03-08	1-06-04 3-09-10	51.64 38.00		
	4	J31 Jack-Open	9 /12	5-10-08	5-11-02	2 x 4	1-03-08	1-06-04 5-11-02	80.72 54.00		
	4	J32 Jack-Open	9 /12	3-05-08	4-01-06	2 x 4	1-03-08	1-06-04 4-01-06	55.92 40.67		
	1	J33 Jack-Open	9 /12	2-03-08	3-02-14	2 x 4	1-03-08	1-06-04 3-02-14	10.86 8.17		
	6	J34 Jack-Open	8 /12	2-04-08	2-09-09	2 x 4	1-03-08	4-07 1-05-02	50.72 36.00		
	4	J35 Jack-Open	8 /12	3-08-08	3-08-03	2 x 4	1-03-08	4-07 2-03-13	47.21 32.00		
	2	C30 Jack-Open	9 /12	1-10-15	2-11-07	2 x 4	1-03-08 1-01-09	1-06-04 2-11-07	21.81 16.67		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH4
 Location: WATERDOWN
 Model: VALLEYCREEK 5A
 Lot #:
 Elevation: 2

Job Track: 51225
 PlanLog: 202410
 Layout ID: 408188
 Ref #
 Page: 3 of 3
 Date: 04-20-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	3	C31 Jack-Open	9 /12	1-10-15	2-11-07	2 x 4	1-03-08 1-01	1-06-04 2-11-07	29.15 21.00		
	1	C32 Jack-Open	9 /12	1-10-15	2-11-07	2 x 4	1-03-08 1-06-09	1-06-04 2-11-07	11.38 8.33		

TOTAL # TRUSS= 80

TOTAL BFT OF ALL TRUSSES= 2648.01

BFT.

TOTAL WEIGHT OF ALL TRSSES 4171.25 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
4	Hardware	LJS26DS	
2	Hardware	LUS26-2	

TOTAL NUMBER OF
ITEMS= 6

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: VALLEYCREEK 5
 Lot #:
 Elevation: EL.2 LOT 553

Job Track: 51225
 PlanLog: 202410
 Layout ID: 421225
 Ref #
 Page: 1 of 3
 Date: 08-25-2021
 Designer: Leo Chen
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T21 Hip Girder	6 /12	31-11-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	285.1 176.00		
	1	T22 Hip	6 /12	31-11-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	129.52 80.83		
	1	T23 Hip	6 /12	31-11-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	129.12 80.67		
	1	T24 Hip	6 /12	31-11-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	135.61 84.17		
	1	T25 Hip	6 /12	31-11-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	131.28 82.50		
	7	T26 Hip	6 /12	31-11-00	9-01-12	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	932.38 582.17		
	1 2-ply	T30 Flat Girder	0 /12	5-10-08	1-09-00	2 x 6		1-09-00 1-09-00	54.63 32.67		
	2	T32 Hip	9 /12	31-11-00	7-05-02	2 x 4	1-03-08 1-03-08	1-06-04 1-06-04	296.23 185.67		
	3	T33 Hip	9 /12	31-11-00	8-11-02	2 x 4	1-03-08 1-03-08	1-06-04 1-06-04	464.85 293.50		
	1 2-ply	T35 Hip Girder	9 /12	31-11-00	5-11-02	2 x 4 2 x 6	1-03-08 1-03-08	1-06-04 1-06-04	315.75 200.67		
	1	T36 Hip Girder	9 /12	10-08-00	3-09-10	2 x 4	1-03-08 1-03-08	1-06-04 1-06-04	49.02 32.33		
	1	T38S Hip Girder	9 /12	13-00-00	5-10-06	2 x 4	1-03-08 1-03-08	1-06-04 1-06-04	62.63 42.00		
	5	T39 Common	9 /12	13-00-00	7-03-04	2 x 4	1-03-08 1-03-08	1-06-04 3-03-04	302.69 192.50		
	1	T137 Common	9 /12	10-05-00	7-03-04	2 x 4	1-03-08	3-03-04 3-05-08	52.4 33.33		



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: VALLEYCREEK 5
 Lot #:
 Elevation: EL.2 LOT 553

Job Track: 51225
 PlanLog: 202410
 Layout ID: 421225
 Ref #
 Page: 2 of 3
 Date: 08-25-2021
 Designer: Leo Chen
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T137CP Hip	9 /12	10-05-00	7-00-10	2 x 4	1-03-08	3-03-04 3-05-08	52.11 33.33		
	2	J1 Jack-Open	6 /12	1-10-15	2-01-08	2 x 4	1-03-08 1-01	1-02-00 2-01-08	14.65 9.33		
	2	J2 Jack-Open	6 /12	2-00-00	3-01-08	2 x 4	1-03-08 1-10-15	1-02-00 2-02-00	19.75 12.00		
	2	J3 Jack-Open	6 /12	1-10-15	2-01-08	2 x 4	1-03-08 3-11-09	1-02-00 2-01-08	23.48 14.67		
	2	J4 Jack-Open	6 /12	3-10-15	3-01-08	2 x 4	1-03-08 1-11-09	1-02-00 3-01-08	28.58 17.33		
	11	J5 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	184.74 117.33		
	4	J30 Jack-Open	9 /12	3-00-08	3-09-10	2 x 4	1-03-08	1-06-04 3-09-10	51.64 38.00		
	4	J31 Jack-Open	9 /12	5-10-08	5-11-02	2 x 4	1-03-08	1-06-04 5-11-02	80.72 54.00		
	4	J32 Jack-Open	9 /12	3-05-08	4-01-06	2 x 4	1-03-08	1-06-04 4-01-06	55.92 40.67		
	1	J33 Jack-Open	9 /12	2-03-08	3-02-14	2 x 4	1-03-08	1-06-04 3-02-14	10.86 8.17		
	6	J34 Jack-Open	8 /12	2-04-08	2-09-09	2 x 4	1-03-08	4-07 1-05-02	50.72 36.00		
	4	J35 Jack-Open	8 /12	3-08-08	3-08-03	2 x 4	1-03-08	4-07 2-03-13	47.21 32.00		
	2	C30 Jack-Open	9 /12	1-10-15	2-11-07	2 x 4	1-03-08 1-01-09	1-06-04 2-11-07	21.81 16.67		
	3	C31 Jack-Open	9 /12	1-10-15	2-11-07	2 x 4	1-03-08 1-01	1-06-04 2-11-07	29.15 21.00		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: VALLEYCREEK 5
 Lot #:
 Elevation: EL.2 LOT 553

Job Track: 51225
 PlanLog: 202410
 Layout ID: 421225
 Ref #
 Page: 3 of 3
 Date: 08-25-2021
 Designer: Leo Chen
 Sales Rep: Mario DiCano

Roof Trusses


PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	C32 Jack-Open	9 /12	1-10-15	2-11-07	2 x 4	1-03-08 1-06-09	1-06-04 2-11-07	11.38 8.33		

TOTAL # TRUSS= 79 TOTAL BFT OF ALL TRUSSES= 2557.84 BFT. TOTAL WEIGHT OF ALL TRSSES 4023.94 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
2	Hardware	HGUS26-2	
4	Hardware	LJS28DS	

TOTAL NUMBER OF ITEMS= 6

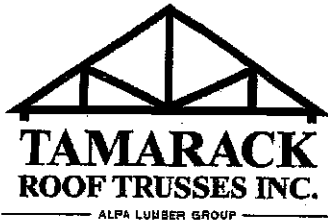


DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH4
 Location: WATERDOWN
 Model: VALLEYCREEK 5A
 Lot #:
 Elevation: 3

Job Track: 51225
 PlanLog: 202410
 Layout ID: 408189
 Ref #
 Page: 1 of 2
 Date: 04-20-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2 2-ply	T21 Hip Girder	6 /12	31-11-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	570.2 352.00		
	2	T22 Hip	6 /12	31-11-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	259.03 161.67		
	2	T23 Hip	6 /12	31-11-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	258.25 161.33		
	2	T24 Hip	6 /12	31-11-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	271.21 168.33		
	2	T25 Hip	6 /12	31-11-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	262.57 165.00		
	8	T26 Hip	6 /12	31-11-00	9-01-12	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1033.89 646.67		
	1	T51 Common	4 /12	10-08-00	2-08-08	2 x 4		11-03 11-03	35.98 23.17		
	1 2-ply	T51Z Common Girder	4 /12	10-08-00	2-08-08	2 x 4		11-03 11-03	71.96 46.33		
	4	T53 Common	4 /12	13-00-00	3-01-03	2 x 4		11-03 11-03	181.41 117.33		
	1 2-ply	T53Z Common Girder	4 /12	13-00-00	3-01-03	2 x 4		11-03 11-03	90.7 58.67		
	1	T55 Common	4 /12	10-08-00	3-01-03	2 x 4		11-03 1-08-08	37.95 24.83		
	4	J1 Jack-Open	6 /12	1-04-07	1-10-04	2 x 4	1-03-08 6-01	1-02-00 1-10-04	25.96 18.67		
	4	J2 Jack-Open	6 /12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	38.28 24.00		
	4	J3 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	46.33 29.33		

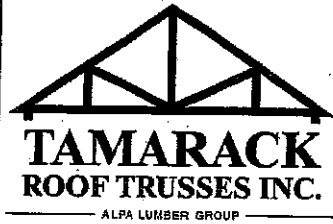

DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH4
 Location: WATERDOWN
 Model: VALLEYCREEK 5A
 Lot #:
 Elevation: 3

Job Track: 51225
 PlanLog: 202410
 Layout ID: 408189
 Ref #
 Page: 2 of 2
 Date: 04-20-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	4	J4 Jack-Open	6 /12	3-10-15	3-01-08	2 x 4	1-03-08 1-11-09	1-02-00 3-01-08	57.17 34.67		
	22	J5 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	369.48 234.67		
	6	J51 GABLE	6 /12	2-04-08	2-01-15	2 x 4	1-03-08	4-03 1-01-11	45.29 32.00		
	4	J52 Jack-Open	6 /12	3-08-08	2-09-15	2 x 4	1-03-08	4-03 1-09-11	43.08 26.67		

TOTAL # TRUSS= 78

TOTAL BFT OF ALL TRUSSES= 2325.34

BFT.

TOTAL WEIGHT OF ALL TRSSES 3698.75 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
11	Hardware	LUS24	


TOTAL NUMBER OF
ITEMS=

11

JOB NAME 408187	TRUSS NAME T1	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	-------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 08:17:44 2020 Page 1
ID:Db7BaD0R9z0At1xT57n_pqzIain3lphxnhH8f6Vb3nOK?cqS4QVZDwYI6C_WEVNSzPyl
Scale = 1:54.8

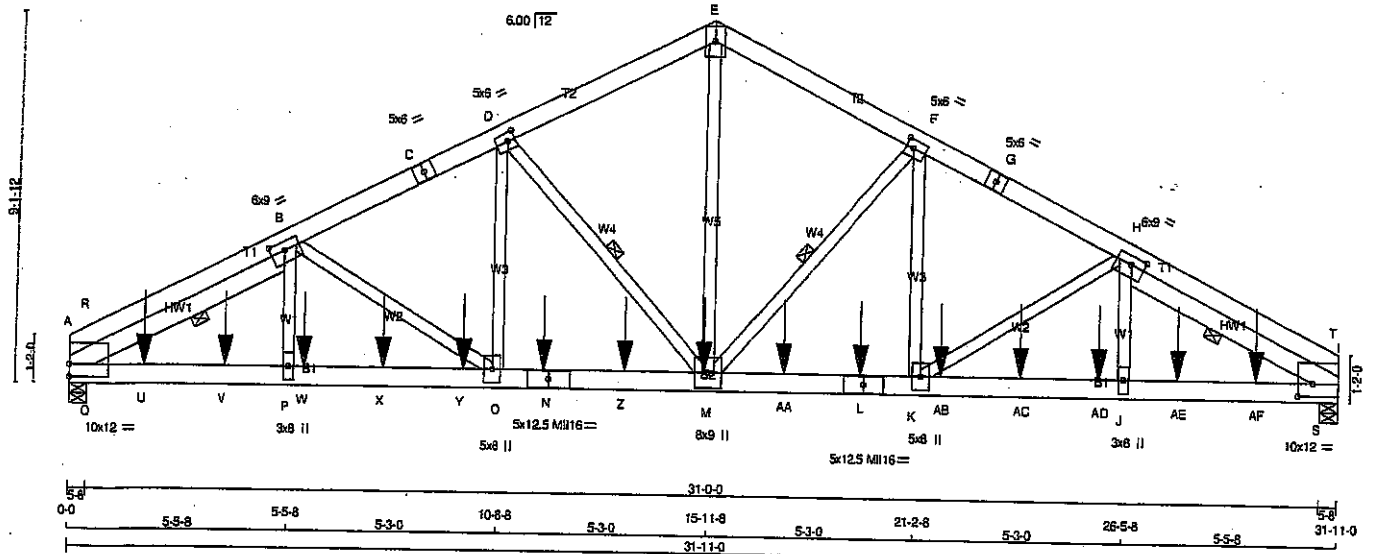

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x6	DRY	No.2	SPF	
C - E	2x6	DRY	No.2	SPF	
E - G	2x6	DRY	No.2	SPF	
G - I	2x6	DRY	No.2	SPF	
A - N	2x6	DRY	2100F 1.8E	SPF	
N - L	2x6	DRY	2100F 1.8E	SPF	
L - I	2x6	DRY	2100F 1.8E	SPF	

REINFORCING MEMBERS	SIZE	LUMBER	DESCR.
HW1	2x6	DRY	No.2
HW2	2x6	DRY	No.2

ALL WEBS	SIZE	LUMBER	DESCR.
DRY: SEASONED LUMBER.	2x4	DRY	No.2

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C	2	12
C-E	2	12
E-G	2	12
G-I	2	12
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
A-N	2	12
N-L	2	12
L-I	2	12
WEBS: (0.122"x3") SPIRAL NAILS		
M-E	1	6
B-P	1	6
2x4	1	6
2x6	2	6

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMBMW+1	MT20	10.0	12.0	3.75	
B	TMBWW+1	MT20	6.0	9.0	2.50	4.25
C	TS-1	MT20	5.0	6.0		
D	TMBWW-1	MT20	5.0	6.0	2.50	2.25
E	TTW+p	MT20	6.0	9.0		
F	TMBWW-1	MT20	5.0	6.0	2.50	2.25
G	TS-1	MT20	5.0	6.0		
H	TMBWW+1	MT20	6.0	9.0	2.50	4.25
I	TMBMW+1	MT20	10.0	12.0	3.75	4.50
J	BMW+w	MT20	3.0	8.0		
K	BMW+w	MT20	3.0	8.0		
L	BS-1	MI16	5.0	12.5		
M	BMWWW+1	MT20	8.0	9.0		
N	BS-1	MI16	5.0	12.5		
O	BMW+w	MT20	5.0	8.0		
P	BMW+w	MT20	3.0	8.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD IN-SX
JT	VERT	HORIZ	DOWN	HORIZ
A	9724	0	9724	0
I	9642	0	9642	0

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE
A	6854	4578	0	0
I	6805	4539	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.05 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-M, D-M, B-Q, H-S.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					W E B S					
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)			
FR-TO		FROM TO		LENGTH	FR-TO					
A-R	-12896	0	-91.8	-91.8	0.44 (1)	3.11	M-E	0.7910	0.80 (1)	
R-B	-7103	0	-91.8	-91.8	0.29 (1)	4.26	M-F	-4061	0	0.62 (1)
B-C	-13576	0	-91.8	-91.8	0.45 (1)	3.08	K-F	0.3829	0.34 (1)	
C-D	-13576	0	-91.8	-91.8	0.45 (1)	3.06	K-H	-1767	0	0.42 (1)
D-E	-10668	0	-91.8	-91.8	0.29 (1)	3.59	J-H	0.2850	0.25 (1)	
E-F	-10668	0	-91.8	-91.8	0.29 (1)	3.59	D-M	-4017	0	0.61 (1)
F-G	-13808	0	-91.8	-91.8	0.46 (1)	3.05	O-D	0.3782	0.33 (1)	
G-H	-13808	0	-91.8	-91.8	0.46 (1)	3.05	B-O	-1789	0	0.43 (1)
H-T	-7040	0	-91.8	-91.8	0.30 (1)	4.27	P-B	0.2856	0.25 (1)	
T-I	-12554	0	-91.8	-91.8	0.44 (1)	3.13	O-R	0.7492	0.00 (1)	
							Q-B	-8985	0	0.82 (1)
A-Q	0	6295	-18.5	-18.5	0.29 (1)	10.00	H-S	-3067	0	0.82 (1)
Q-U	0	13720	-18.5	-18.5	0.55 (1)	10.00	S-T	0	7387	0.00 (1)
U-V	0	13720	-18.5	-18.5	0.55 (1)	10.00				
V-P	0	13720	-18.5	-18.5	0.55 (1)	10.00				
P-W	0	13656	-18.5	-18.5	0.59 (1)	10.00				
W-X	0	13656	-18.5	-18.5	0.59 (1)	10.00				
X-Y	0	13656	-18.5	-18.5	0.59 (1)	10.00				
Y-O	0	13656	-18.5	-18.5	0.59 (1)	10.00				
O-N	0	12168	-18.5	-18.5	0.56 (1)	10.00				
N-Z	0	12168	-18.5	-18.5	0.56 (1)	10.00				
Z-M	0	12168	-18.5	-18.5	0.56 (1)	10.00				
M-AA	0	12197	-18.5	-18.5	0.56 (1)	10.00				
AA-L	0	12197	-18.5	-18.5	0.56 (1)	10.00				
L-K	0	12197	-18.5	-18.5	0.56 (1)	10.00				
K-AB	0	13666	-18.5	-18.5	0.59 (1)	10.00				
AB-AC	0	13666	-18.5	-18.5	0.59 (1)	10.00				
AC-AD	0	13666	-18.5	-18.5	0.59 (1)	10.00				
AD-J	0	13666	-18.5	-18.5	0.59 (1)	10.00				
J-AE	0	13730	-18.5	-18.5	0.56 (1)	10.00				
AE-AF	0	13730	-18.5	-18.5	0.56 (1)	10.00				
AF-S	0	13730	-18.5	-18.5	0.56 (1)	10.00				
S-I	0	8237	-18.5	-18.5	0.29 (1)	10.00				

LICENSED PROFESSIONAL

04/20/20

H. J. G. ALVAREZ

100009822

PROVIDENCE OF ON

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
L	19-10-4	-1056	-1056	---	BACK	VERT	TOTAL	---	C1
M	19-10-4	-1056	-1056	---	BACK	VERT	TOTAL	---	C1
N	11-10-4	-1056	-1056	---	BACK	VERT	TOTAL	---	C1
U	1-10-4	-1056	-1056	---	BACK	VERT	TOTAL	---	C1

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(56 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.06")
CALCULATED VERT. DEFL. (LL) = L/999 (0.21")
ALLOWABLE DEFL. (TL) = L/360 (1.06")
CALCULATED VERT. DEFL. (TL) = L/999 (0.38")

CSI: TC=0.46/1.00 (F-H:1), BC=0.59/1.00 (O-P:1),
WB=0.80/1.00 (E-M:1), SSI=0.58/1.00 (I-O-P:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MT20	618	354
MI16	438	276

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (H) (INPUT = 0.90)
JSI METAL = 0.82 (A) (INPUT = 1.00)

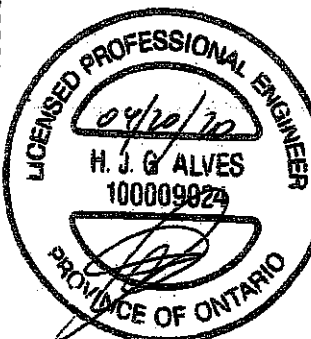

Structural component only 1/3


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408187	T1	1	2	GREEN PARK HOMES	
Tamarack Road Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Fri Apr 17 08:17:44 2020 Page 2
ID:Db?BaD0R9zOAt1xT57n pqzlaIn-3lphxnhtHSfBVb3nOK?cgS4QVZDwYI6C WEVNSzPty

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
W	5-10-4	-1056	-1056	---	BACK	VERT	TOTAL	---	C1
X	7-10-4	-1056	-1056	---	BACK	VERT	TOTAL	---	C1
Y	9-10-4	-1056	-1056	---	BACK	VERT	TOTAL	---	C1
Z	13-10-4	-1056	-1056	---	BACK	VERT	TOTAL	---	C1
AA	17-10-4	-1056	-1056	---	BACK	VERT	TOTAL	---	C1
AB	21-10-4	-1056	-1056	---	BACK	VERT	TOTAL	---	C1
AC	23-10-4	-1056	-1056	---	BACK	VERT	TOTAL	---	C1
AD	25-10-4	-1056	-1056	---	BACK	VERT	TOTAL	---	C1
AE	27-10-4	-1056	-1056	---	BACK	VERT	TOTAL	---	C1
AF	29-10-4	-1056	-1056	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

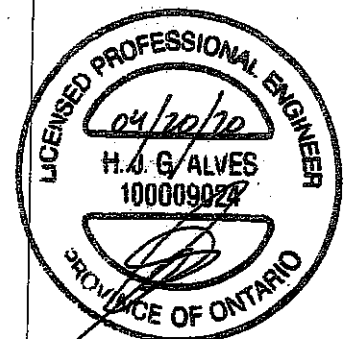


Structural component only

JOB NAME 408187	TRUSS NAME T2	QUANTITY 15	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	------------------	----------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:17:45 2020 Page 1
ID:Db?BaD0R9zOAt1xT57n_pqzlaN-XyN387IV2mn?7le_y1WrMfdXLzeVHJALDA_2vuzPtyI

Scale = 1:43.

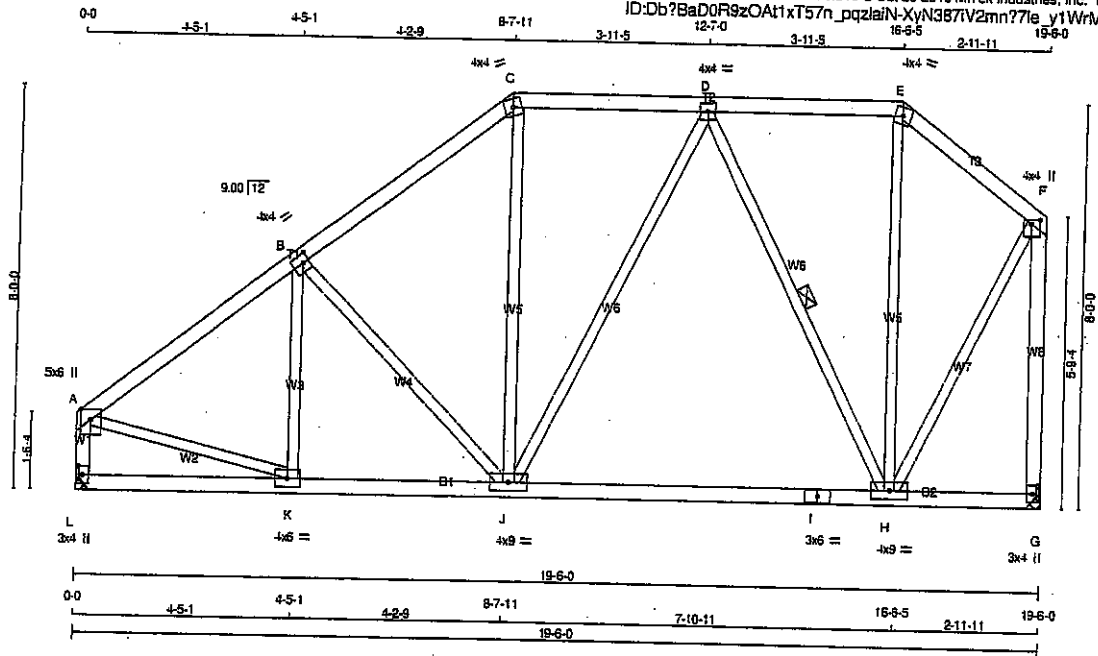

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF		
C - E	2x4 DRY	No.2	SPF		
E - F	2x4 DRY	No.2	SPF		
L - A	2x4 DRY	No.2	SPF		
G - F	2x4 DRY	No.2	SPF		
L - I	2x4 DRY	No.2	SPF		
I - G	2x4 DRY	No.2	SPF		
ALL WEBS	2x3 DRY	No.2	SPF		
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-p	MT20	5.0	6.0	Edge	
B	TMWW-t	MT20	4.0	4.0	2.00	1.50
C	TTW-m	MT20	4.0	4.0		
D	TMWW-t	MT20	4.0	4.0		
E	TTW-m	MT20	4.0	4.0		
F	TMVW-p	MT20	4.0	4.0	1.00	2.00
G	BMV1-p	MT20	3.0	4.0		
H	BMWWW-t	MT20	4.0	9.0		
I	BS-t	MT20	3.0	6.0		
J	BMWWW-t	MT20	4.0	9.0		
K	BMWW-t	MT20	4.0	6.0		
L	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
L	1075	0	1075	0
G	1075	0	1075	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT L. G. MINIMUM BEARING LENGTH AT JOINT L = 3-8, JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
L	760	499.0	0.0	0.0	261.0	0.0
G	760	499.0	0.0	0.0	261.0	0.0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.87 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF D-H.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH
FR-TO						FR-TO			
A-B	-1052.0	-91.8	-91.8	0.23 (1)	5.87	K-B	-162.5	0.06 (1)	
B-C	-879.0	-91.8	-91.8	0.23 (1)	6.25	B-J	-268.0	0.18 (1)	
C-D	-682.0	-91.8	-91.8	0.18 (1)	6.25	J-C	0.226	0.05 (1)	
D-E	-369.0	-91.8	-91.8	0.18 (1)	6.25	J-D	0.102	0.03 (4)	
E-F	-463.0	-91.8	-91.8	0.11 (1)	6.25	D-H	-598.0	0.30 (1)	
L-A	-1038.0	0.0	0.0	0.11 (1)	7.71	H-E	0.50	0.02 (4)	
G-F	-1070.0	0.0	0.0	0.71 (1)	7.62	A-K	0.895	0.20 (1)	
						H-F	0.751	0.17 (1)	
L-K	0.0	-18.5	-18.5	0.08 (4)	10.00				
K-J	0.864	-18.5	-18.5	0.24 (4)	10.00				
J-I	0.836	-18.5	-18.5	0.23 (4)	10.00				
I-H	0.836	-18.5	-18.5	0.23 (4)	10.00				
H-G	0.0	-18.5	-18.5	0.18 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.85")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.85")
CALCULATED VERT. DEFL.(TL) = L/999 (0.09")

CSI: TC=0.71/1.00 (F-G-1), BC=0.24/1.00 (J-K-4),
WB=0.30/1.00 (D-H-1), SS=0.17/1.00 (C-D-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1655


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

J-I GRIP= 0.85 (H) (INPUT = 0.90)
J-I METAL= 0.41 (A) (INPUT = 1.00)

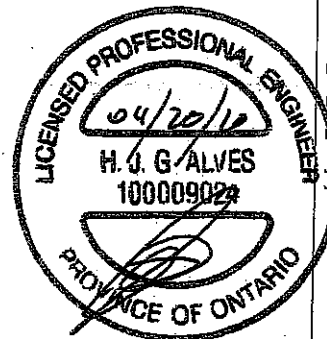

Structural component only

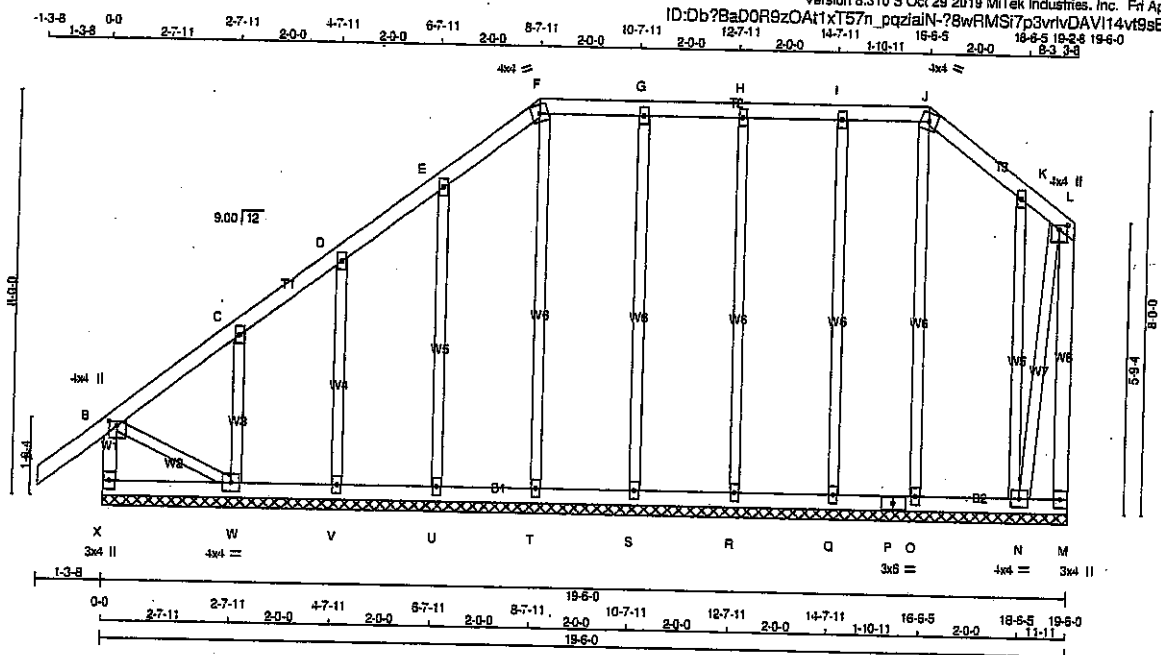

LUMBER

N.L.G.A. RULES	CHORDS	SIZE	LUMBER	DESCR.
X - B	2x4	DRY	No.2	SPF
A - F	2x4	DRY	No.2	SPF
F - J	2x4	DRY	No.2	SPF
J - L	2x4	DRY	No.2	SPF
M - L	2x4	DRY	No.2	SPF
X - P	2x4	DRY	No.2	SPF
P - M	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
 DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C, D, E, G, H, I, K						
C	TMW+w	MT20	2.0	4.0		
F	TTW-m	MT20	4.0	4.0		
J	TTW-m	MT20	4.0	4.0		
L	TMVW+p	MT20	4.0	4.0	1.00	2.00
M	BMV1+p	MT20	3.0	4.0		
N	BMVW1-t	MT20	4.0	4.0		
O, Q, R, S, T, U, V						
O	BMV1+w	MT20	2.0	4.0		
P	BS-t	MT20	3.0	6.0		
W	BMVW1-t	MT20	4.0	4.0		
X	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED		MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
			VERT. LOAD	LC1					
FR-TO			FROM	TO		FR-TO			
X-B		-247.0	0.0	0.0	0.03 (1)	T-F		-147.0	0.18 (1)
A-B		0.38	-91.8	-91.8	0.12 (1)	C-J		-139.0	0.17 (1)
B-C		-8.0	-91.8	-91.8	0.08 (1)	S-W		0.19	0.00 (1)
C-D		-24.0	-91.8	-91.8	0.08 (1)	W-C		-249.0	0.05 (1)
D-E		-5.0	-91.8	-91.8	0.05 (1)	V-D		-156.0	0.06 (1)
E-F		-17.0	-91.8	-91.8	0.05 (1)	U-E		-207.0	0.15 (1)
F-G		-3.0	-91.8	-91.8	0.05 (1)	N-K		-178.0	0.13 (1)
G-H		-3.0	-91.8	-91.8	0.05 (1)	N-L		0.9	0.00 (1)
H-I		-3.0	-91.8	-91.8	0.04 (1)	S-G		-211.0	0.25 (1)
I-J		-3.0	-91.8	-91.8	0.04 (1)	R-H		-178.0	0.22 (1)
J-K		-14.0	-91.8	-91.8	0.05 (1)	Q-I		-192.0	0.23 (1)
K-L		0.14	-91.8	-91.8	0.04 (1)				
M-L		-30.0	0.0	0.0	0.02 (1)				
X-W		0.0	-18.5	-18.5	0.03 (4)				
W-V		0.11	-18.5	-18.5	0.03 (4)				
V-U		0.8	-18.5	-18.5	0.02 (4)				
U-T		0.5	-18.5	-18.5	0.02 (4)				
T-S		0.3	-18.5	-18.5	0.01 (4)				
S-R		0.3	-18.5	-18.5	0.02 (4)				
R-Q		0.3	-18.5	-18.5	0.02 (4)				
Q-P		0.3	-18.5	-18.5	0.01 (4)				
P-O		0.3	-18.5	-18.5	0.01 (4)				
O-N		0.5	-18.5	-18.5	0.01 (4)				
N-M		0.0	-18.5	-18.5	0.01 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF

BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (A-B:1), BC=0.03/1.00 (V-W:4)
 WB=0.26/1.00 (G-S:1), SS=0.09/1.00 (B-C:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1667 788	1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.62 (J) (INPUT = 0.90)
 JSI METAL = 0.13 (C) (INPUT = 1.00)

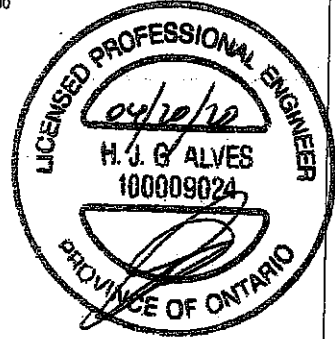

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408187	T4G	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 9.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:17:49 2020 Page 1					
ID:Db?BaDOR9zOAt1xT57n_pqzIain-xX2Bn8kNLh9Z_CNZdA3Y_IFCgAjmUfQov8CfWCzPyl					
11-3-0 13-3-0 15-3-0 17-3-0 18-6-0 19-9-8					
1-3-8 0-0 1-3-0 3-3-0 5-3-0 7-3-0 9-3-0 2-0-0 2-0-0 2-0-0 2-0-0 2-0-0 2-0-0 1-3-0 1-3-8					
4x4 =					

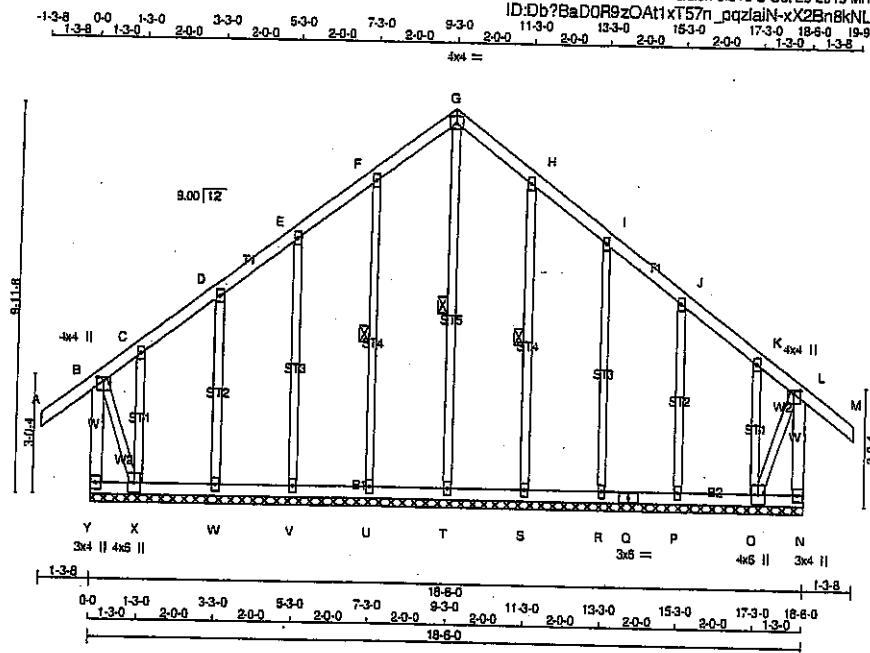

Scale = 1/8" = 1'-0"

LUMBER	SIZE	LUMBER
N.L.G.A. RULES		
CHORDS		
A - G	2x4	DRY No.2
G - M	2x4	DRY No.2
Y - B	2x4	DRY No.2
N - L	2x4	DRY No.2
Y - Q	2x4	DRY No.2
Q - N	2x4	DRY No.2
ALL WEBS	2x3	DRY No.2
ALL GABLE WEBS	2x3	DRY No.2
DRY: SEASONED LUMBER.		

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00
C, D, E, F, H, I, J, K					
G TMVW+p	MT20	2.0	4.0		
C TTW+p	MT20	4.0	4.0	2.25	2.00
L TMVW+p	MT20	4.0	4.0	1.00	2.00
N BMV1+p	MT20	3.0	4.0		
O BMVW1+p	MT20	4.0	6.0		
P, R, S, T, U, V, W					
P BMV1+p	MT20	2.0	4.0		
Q BS-t	MT20	3.0	6.0		
X BMVW1+p	MT20	4.0	6.0		
Y BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-T, F-U, H-S.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0:38	-91.8 -91.8 0.12 (1)	10.00	T-G	-171:0	0.11 (1)	
B-C	-37:0	-91.8 -91.8 0.12 (1)	6.25	U-F	-210:0	0.10 (1)	
C-D	0:11	-91.8 -91.8 0.05 (1)	10.00	V-E	-174:0	0.14 (1)	
D-E	0:7	-91.8 -91.8 0.05 (1)	10.00	W-D	-195:0	0.09 (1)	
E-F	0:14	-91.8 -91.8 0.06 (1)	10.00	X-C	-68:0	0.02 (1)	
F-G	0:3	-91.8 -91.8 0.05 (1)	10.00	S-H	-210:0	0.10 (1)	
G-H	0:3	-91.8 -91.8 0.05 (1)	10.00	R-I	-174:0	0.14 (1)	
H-I	0:14	-91.8 -91.8 0.08 (1)	10.00	P-J	-195:0	0.09 (1)	
I-J	0:7	-91.8 -91.8 0.05 (1)	10.00	O-K	-68:0	0.02 (1)	
J-K	0:11	-91.8 -91.8 0.05 (1)	10.00	B-X	-4:0	0.00 (1)	
K-L	-37:0	-91.8 -91.8 0.12 (1)	6.25	O-L	-4:0	0.00 (1)	
L-M	0:38	-91.8 -91.8 0.12 (1)	10.00				
Y-B	-240:0	0.0 0.0 0.04 (1)	7.81				
N-L	-240:0	0.0 0.0 0.04 (1)	7.81				
Y-X	0:0	-18.5 -18.5 0.01 (4)	10.00				
X-W	-3:0	-18.5 -18.5 0.02 (4)	10.00				
W-V	-7:0	-18.5 -18.5 0.02 (4)	10.00				
V-U	-9:0	-18.5 -18.5 0.01 (4)	10.00				
U-T	-11:0	-18.5 -18.5 0.01 (4)	6.25				
T-S	-11:0	-18.5 -18.5 0.01 (4)	6.25				
S-R	-9:0	-18.5 -18.5 0.01 (4)	10.00				
R-Q	-7:0	-18.5 -18.5 0.02 (4)	10.00				
Q-P	-7:0	-18.5 -18.5 0.02 (4)	10.00				
P-O	-3:0	-18.5 -18.5 0.02 (4)	10.00				
O-N	0:0	-18.5 -18.5 0.01 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS1: TC=0.12/1.00 (L-M:1), BC=0.02/1.00 (P-R:4), WB=0.14/1.00 (I-R:1), SS=0.08/1.00 (L-M:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION	(PSI)	(PL)	(PL)
MAX MIN MAX MIN MAX MIN			
MT20	618	354	1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.49 (L) (INPUT = 0.90)
JSI METAL= 0.11 (H) (INPUT = 1.00)

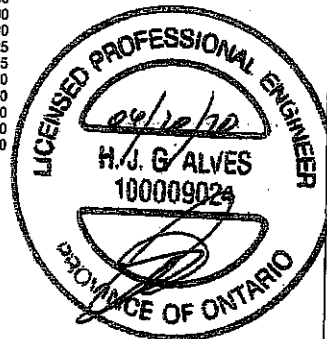

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408187	T5	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:17:50 2020 Page 1
ID:Db7BaD0R9zOAMxT57n_pqzlaIn-uvAyCqleslPHDWWXkb603IKW4_CPyT94MShpa6zPtyF

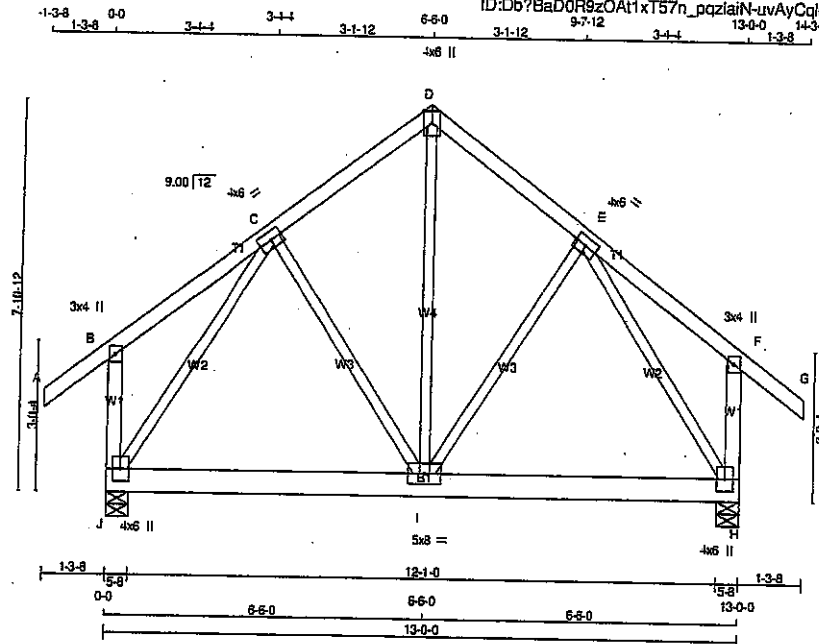

Scale = 1:24.8

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2		
D - G	2x4	DRY	No.2		
J - B	2x4	DRY	No.2		
H - F	2x4	DRY	No.2		
J - H	2x6	DRY	No.2		
ALL WEBS	2x3	DRY	No.2		
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0			
C	TMWW-t	MT20	4.0	6.0			
D	TTW+p	MT20	4.0	6.0			Edge
E	TMWW-t	MT20	4.0	6.0			
F	TMV+p	MT20	3.0	4.0			
H	BMVW1+p	MT20	4.0	6.0			
I	BMVWW-t	MT20	5.0	8.0			
J	BMVW1+p	MT20	4.0	6.0			

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
J	1493	0	1493	0
H	1493	0	1493	0

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	1114	403 0	0 0	0 0	0 0	711 0	0 0
H	1114	403 0	0 0	0 0	0 0	711 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	LC2 MAX	UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO							FR-TO			
A-B	0	38	-91.8	-91.8	0.18 (1)	10.00	I-D	0	775	0.27 (4)
B-C	0	19	-91.8	-91.8	0.18 (1)	10.00	I-E	0	207	0.08 (4)
C-D	-858	0	-91.8	-91.8	0.19 (1)	6.25	C-I	0	207	0.08 (4)
D-E	-858	0	-91.8	-91.8	0.19 (1)	6.25	J-C	-1134	0	0.70 (1)
E-F	0	19	-91.8	-91.8	0.18 (1)	10.00	E-H	-1134	0	0.70 (1)
F-G	0	38	-91.8	-91.8	0.18 (1)	10.00				
J-B	-245	0	0.0	0.0	0.04 (1)	7.81				
H-F	-245	0	0.0	0.0	0.04 (1)	7.81				
J-I	0	816	-118.5	-118.5	0.84 (4)	10.00				
I-H	0	816	-118.5	-118.5	0.84 (4)	10.00				

TOTAL WEIGHT = 3 X 75 = 225 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF	

SPACING = 24.0 IN. C/C

*** NON STANDARD GIRDER ***
ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.43")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.43")
CALCULATED VERT. DEFL.(TL) = L/999 (0.07")

CSI: TC=0.19/1.00 (C-D:1), BC=0.84/1.00 (I-J:4), WB=0.70/1.00 (C-J:1), SS=0.55/1.00 (I-J:4)

DOL LUMBER=0.88 NAIL=0.88 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PL)	(PL)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP = 0.76 (E) (INPUT = 0.90)
JSI METAL = 0.32 (H) (INPUT = 1.00)

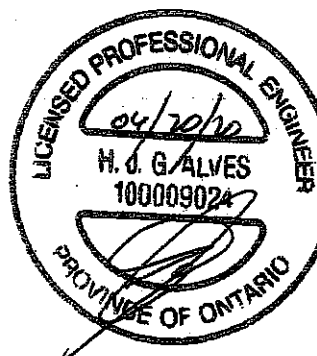

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408187	T5S	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 08:17:51 2020 Page 1
ID:Db?BaD0R9zOA11xT57n_pqzlaIn-M6kKPAmGdcX8rg57ldFowthrNFvh3NEb6RM6YzPtye

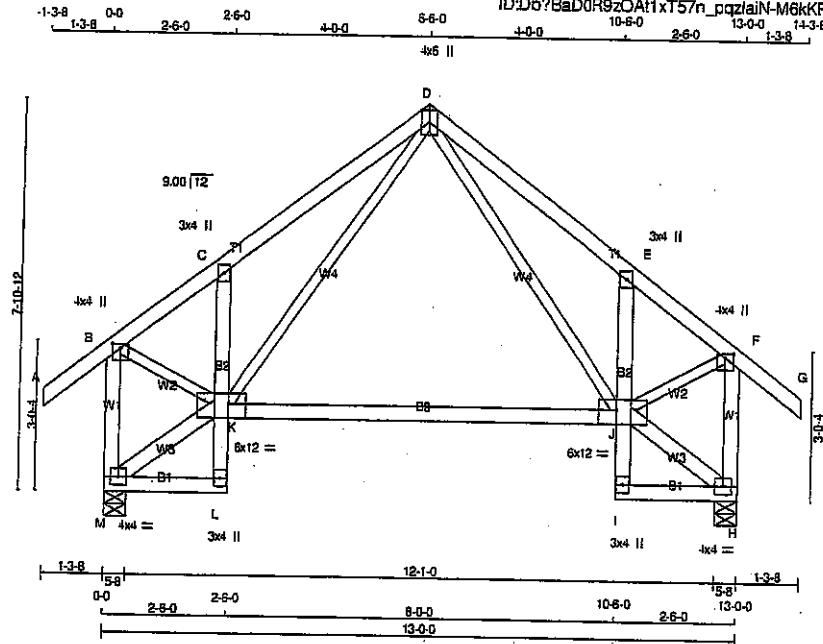

Scale = 1/4"=1'-0"

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
M - B	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
M - L	2x4	DRY	No.2	SPF	
L - O	2x4	DRY	No.2	SPF	
K - J	2x4	DRY	No.2	SPF	
I - E	2x4	DRY	No.2	SPF	
I - H	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
M - K	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TMV+p	MT20	3.0	4.0		
D	TTVW+p	MT20	4.0	6.0	Edge	
E	TMV+p	MT20	3.0	4.0		
F	TMVW+p	MT20	4.0	4.0	1.00	2.00
H	BMVW1-t	MT20	4.0	4.0		
I	BMV+p	MT20	3.0	4.0		
J	BMVWVW-t	MT20	6.0	12.0	Edge	4.50
K	BMVWVW-t	MT20	6.0	12.0	Edge	4.50
L	BMV+p	MT20	3.0	4.0		
M	BMVW1-t	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UPLIFT	IN-SX
M	843	0	0	5-8
H	843	0	0	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
M	594	403	0	0	0	191	0
H	594	403	0	0	0	191	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MAX. FACTORED UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO						FR-TO			
A-B	0:38	-91.8	-91.8	0.12 (1)	10.00	D-J	0:266	0.06 (1)	
B-C	-608.0	-91.8	-91.8	0.15 (1)	6.25	K-D	0:266	0.06 (1)	
C-D	-655.0	-91.8	-91.8	0.19 (1)	6.25	M-K	-8.0	0.00 (1)	
D-E	-655.0	-91.8	-91.8	0.19 (1)	6.25	B-K	0:578	0.13 (1)	
E-F	-608.0	-91.8	-91.8	0.15 (1)	6.25	J-H	-8.0	0.00 (1)	
F-G	0:38	-91.8	-91.8	0.12 (1)	10.00	J-F	0:578	0.13 (1)	
M-B	-817.0	0.0	0.0	0.13 (1)	7.81				
H-F	-817.0	0.0	0.0	0.13 (1)	7.81				
M-L	0:7	-18.5	-18.5	0.03 (4)	10.00				
L-K	0:24	0.0	0.0	0.02 (1)	10.00				
K-C	-387.0	0.0	0.0	0.02 (1)	7.81				
K-J	0:358	-18.5	-18.5	0.40 (4)	10.00				
I-J	0:24	0.0	0.0	0.02 (1)	10.00				
J-E	-387.0	0.0	0.0	0.02 (1)	7.81				
I-H	0:7	-18.5	-18.5	0.03 (4)	10.00				

TOTAL WEIGHT = 2 X 74 = 147 lb (MIF)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA D86-09, CSA D86-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.43")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.43")
CALCULATED VERT. DEFL.(TL)= L/ 678 (0.23")

CSI: TC=0.19/1.00 (C-D:1), BC=0.40/1.00 (J-K:4), WB=0.13/1.00 (B-K:1), SS=0.14/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
	MAX MIN	MAX MIN
MT20	618 354	1687 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

ISI GRIP = 0.74 (B) (INPUT = 0.90)
ISI METAL = 0.20 (F) (INPUT = 1.00)

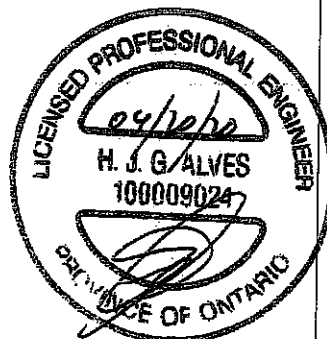

[illegible]

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
<u>BEARINGS</u>							
JT S K	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
	3049	0	3049	0	0	5-8	5-8
	3047	0	3047	0	0	5-8	5-8

K	2156	1416	0	0.0	0.0	0.0	741	0	0.0
S	2155	1415	0	0.0	0.0	0.0	740	0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.40 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID JOINTING SYSTEM

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	LCT (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)		
FR-TO		FROM	TO	LENGTH	FR-TO				
A-B		-91.8	-91.8	0.07 (1)	10.00	R-C	-342 / 39 0.04 (1)		
B-C	-4568.0	-91.8	-91.8	0.48 (1)	4.07	C-Q	0 / 2360 0.29 (1)		
C-T	-5980.0	-91.8	-91.8	0.49 (1)	3.57	Q-D	-1232 / 0 0.18 (1)		
T-U	-5980.0	-91.8	-91.8	0.49 (1)	3.57	D-O	0 / 679 0.18 (1)		
U-D	-5980.0	-91.8	-91.8	0.49 (1)	3.57	O-E	-660 / 0 0.09 (1)		
D-V	-6524.0	-91.8	-91.8	0.52 (1)	3.40	O-G	0 / 683 0.08 (1)		
V-W	-6524.0	-91.8	-91.8	0.52 (1)	3.40	M-G	-1232 / 0 0.29 (1)		

W-E	-6524	0	-91.8	-91.8	0.52 (1)	3.40	M-H	-342	38	0.16 (1)
E-F	-8524	0	-91.8	-91.8	0.52 (1)	3.40	L-H	-342	38	0.29 (1)
F-X	-8524	0	-91.8	-91.8	0.52 (1)	3.40	B-R	0	4118	0.04 (1)
X-G	-6524	0	-91.8	-91.8	0.52 (1)	3.40	L-I	0	4115	0.51 (1)
G-Y	-5977	0	-91.8	-91.8	0.49 (1)	3.58				
Y-Z	-5977	0	-91.8	-91.8	0.49 (1)	3.58				
Z-H	-5977	0	-91.8	-91.8	0.49 (1)	3.58				
H-I	-4565	0	-91.8	-91.8	0.48 (1)	4.08				
I-J	0	28	-91.8	-91.8	0.07 (1)	10.00				
J-B	-2971	0	0.0	0.0	0.10 (1)	7.81				
K-I	-2969	0	0.0	0.0	0.10 (1)	7.81				
G-AA	0	0	-18.5	-18.5	0.07 (4)	10.00				
A-AB	0	0	-18.5	-18.5	0.07 (4)	10.00				
B-R	0	0	-18.5	-18.5	0.07 (4)	10.00				
A-AC	0	0	-18.5	-18.5	0.07 (4)	10.00				

LOC.	LOC1	MAX-	MAX+	FACE	DIRL	TYPE	HEEL	CONN.
C-AD	0	4074	-18.5	-18.5	0.30 (1)	10.00		
D-O	0	4074	-18.5	-18.5	0.30 (1)	10.00		
D-P	0	5980	-18.5	-18.5	0.30 (1)	10.00		
E-AE	0	5980	-18.5	-18.5	0.45 (1)	10.00		
E-O	0	5980	-18.5	-18.5	0.45 (1)	10.00		
D-AF	0	5977	-18.5	-18.5	0.45 (1)	10.00		
F-N	0	5977	-18.5	-18.5	0.45 (1)	10.00		
L-M	0	5977	-18.5	-18.5	0.45 (1)	10.00		
G-AG	0	4071	-18.5	-18.5	0.30 (1)	10.00		
G-AH	0	4071	-18.5	-18.5	0.30 (1)	10.00		
H-L	0	4071	-18.5	-18.5	0.30 (1)	10.00		
H-AI	0	0	-18.5	-18.5	0.07 (4)	10.00		
H-AJ	0	0	-18.5	-18.5	0.07 (4)	10.00		
J-K	0	0	-18.5	-18.5	0.07 (4)	10.00		

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408187	T21	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington


Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 08:17:52 2020 Page 2

ID:1ebEM4Ce92xn94Zv?ikFPizmBR3-glicWnuOvf?TqgKs?8U97PnUn vQRINgmAwf zPtyC

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
H	25-0-8	-469	-469	---	FRONT	VERT	TOTAL	---	C1
L	25-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
N	19-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
O	15-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
P	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	19-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	21-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	23-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	2-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AB	4-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AC	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AD	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AE	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AF	17-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	21-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	23-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	27-10-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	29-10-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1


CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

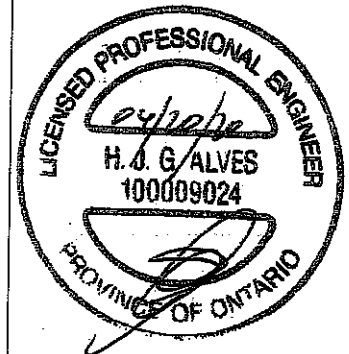

JOB NAME 408130	TRUSS NAME T22	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Wed Apr 15 16:45:48 2020 Page 1
 ID:1abEM4C892xn94Zv7jkFPizmBR3-0VWMW?N2usk7lgJolQlztncd6_vghHXtywKizQCil1
 19-7-7 5-5-1 24-0-8 31-11-0 33-2-8
 Scale = 1:32.6

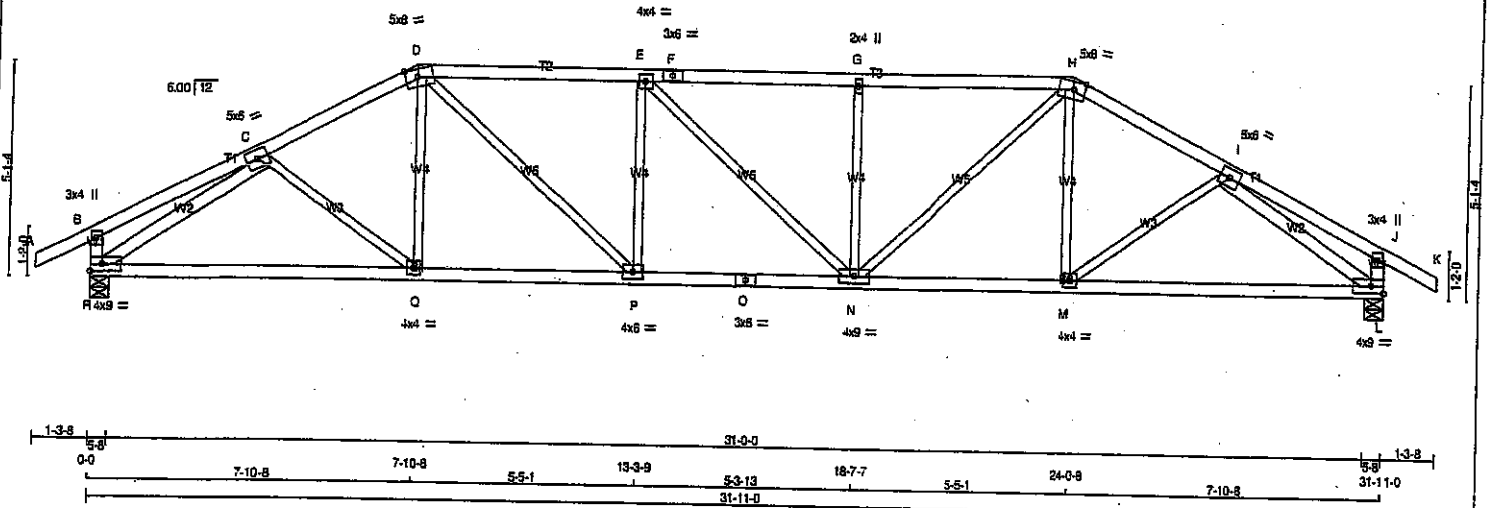

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - J	2x4	DRY	No.2
J - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
R - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
C	TMVW-t	MT20	5.0	6.0	
D	TTVW-m	MT20	5.0	8.0	2.25 3.50
E	TMVW-t	MT20	4.0	4.0	
F	TS-t	MT20	3.0	6.0	
G	TMVW-w	MT20	2.0	4.0	
H	TTVW-m	MT20	5.0	8.0	2.25 3.50
I	TMVW-t	MT20	5.0	6.0	
J	TMV+p	MT20	3.0	4.0	
L	BMVW1-t	MT20	4.0	9.0	Edge
M	BMVW1-t	MT20	4.0	4.0	
N	BMVW1-t	MT20	4.0	9.0	
O	BS-t	MT20	3.0	6.0	
P	BMVW1-t	MT20	4.0	6.0	
Q	BMVW1-t	MT20	4.0	4.0	
R	BMVW1-t	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	UP	IN-SX	IN-SX
R	1884	0	0	5-8	5-8
L	1884	0	0	5-8	5-8

UNFACTORED REACTIONS		1ST LCASE	MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
R	1330	886 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0	
L	1330	886 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, L

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.61 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. CS1 (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LBS)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	C-Q	0 / 74	0.03 (4)
B-C	0 / 17	-91.8	-91.8 0.20 (1)	10.00	C-D	0 / 133	0.04 (4)
C-D	-2468 / 0	-91.8	-91.8 0.30 (1)	4.12	D-P	0 / 933	0.21 (1)
D-E	-2893 / 0	-91.8	-91.8 0.54 (1)	3.61	P-E	-534 / 0	0.21 (1)
E-F	-2891 / 0	-91.8	-91.8 0.53 (1)	3.61	E-N	-2 / 0	0.00 (1)
F-G	-2891 / 0	-91.8	-91.8 0.53 (1)	3.61	N-G	-539 / 0	0.21 (1)
G-H	-2468 / 0	-91.8	-91.8 0.30 (1)	4.12	N-H	0 / 931	0.21 (1)
H-I	0 / 17	-91.8	-91.8 0.20 (1)	10.00	M-H	0 / 134	0.04 (4)
I-J	0 / 28	-91.8	-91.8 0.12 (1)	10.00	M-I	0 / 74	0.03 (4)
J-K	-269 / 0	0 / 0	0.03 (1)	7.81	R-C	-2668 / 0	0.74 (1)
K-L	-269 / 0	0 / 0	0.03 (1)	7.81	L-L	-2667 / 0	0.74 (1)
R-Q	0 / 2167	-18.5	-18.5 0.49 (1)	10.00			
Q-P	0 / 2194	-18.5	-18.5 0.48 (1)	10.00			
P-O	0 / 2893	-18.5	-18.5 0.53 (1)	10.00			
O-N	0 / 2893	-18.5	-18.5 0.53 (1)	10.00			
N-M	0 / 2194	-18.5	-18.5 0.49 (1)	10.00			
M-L	0 / 2168	-18.5	-18.5 0.49 (1)	10.00			

TOTAL WEIGHT = 2 X 130 = 260 lb

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.8 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 33.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF NBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 089-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.06")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.15")
 ALLOWABLE DEFL.(TL) = L/360 (1.06")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.28")

CSI: TC=0.54/1.00 (D-E:1), BC=0.53/1.00 (N-P:1), WB=0.74/1.00 (H-L:1), SS=0.23/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

GRIP = 0.84 (O) (INPUT = 0.90)
 METAL = 0.94 (O) (INPUT = 1.00)

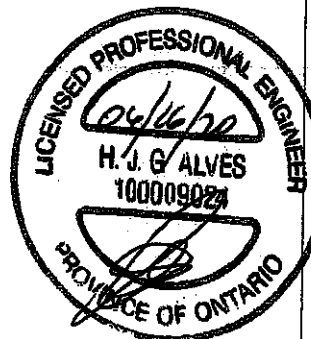


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408130	T26	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Wed Apr 15 16:45:33 2020 Page 1

ID:1ebEM4Ce92xn942v7kFPizmBR3-NSKF JRA|OzPpSCi8zLBYxUW27iyL7WGdEcW_WzQQhY

Scale = 1:53.1

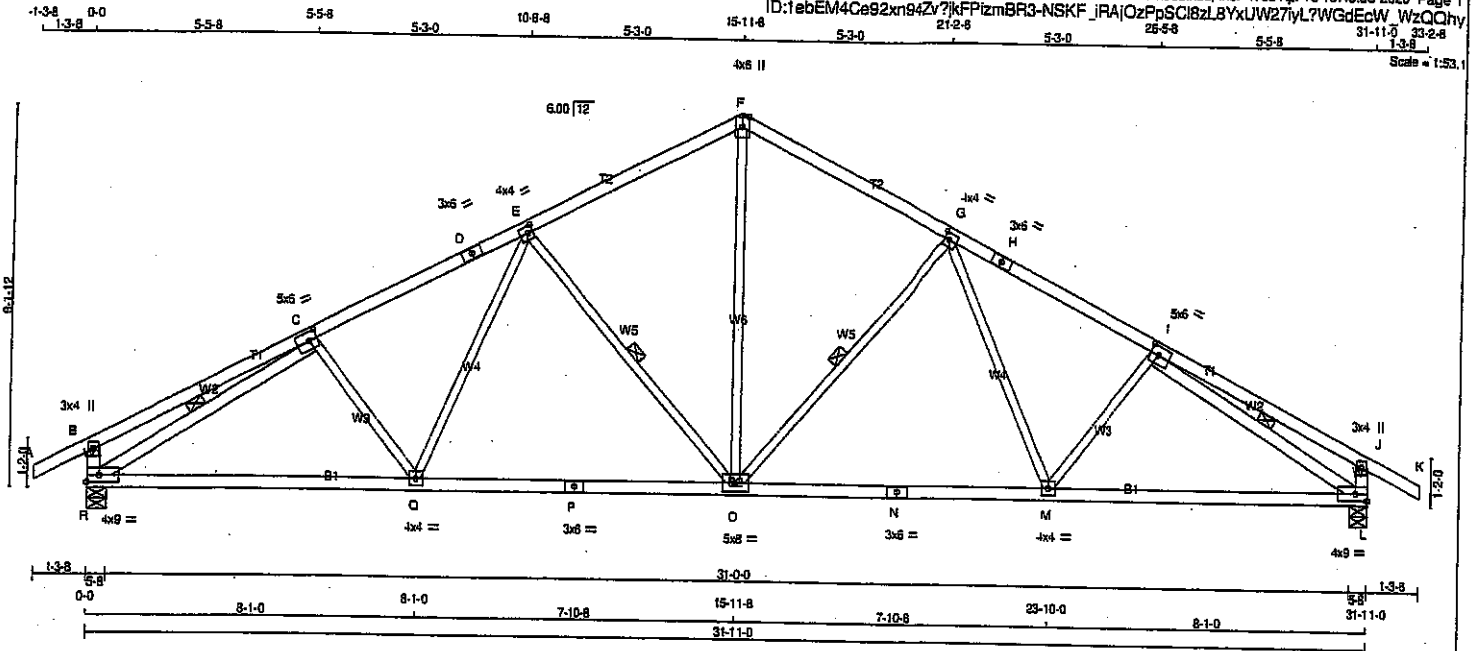

LUMBER				DESCR.	
N. L. G. A. RULES					
CHORDS	SIZE	DRY	LUMBER	SPF	
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - K	2x4	DRY	No.2	SPF	
R - B	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
R - P	2x4	DRY	No.2	SPF	
P - N	2x4	DRY	No.2	SPF	
N - L	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
R - C	2x4	DRY	No.2	SPF	
I - L	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
C	TMVW-1	MT20	5.0	8.0	2.50 2.50
D	TS-1	MT20	3.0	6.0	
E	TMVW-1	MT20	4.0	4.0	2.00 1.50
F	TTW+p	MT20	4.0	8.0	Edge
G	TMVW-1	MT20	4.0	4.0	2.00 1.50
H	TS-1	MT20	3.0	6.0	
I	TMVW-1	MT20	5.0	8.0	2.50 2.50
J	TMV+p	MT20	3.0	4.0	
L	BMVW-1	MT20	4.0	9.0	Edge
M	BMVW-1	MT20	4.0	4.0	
N	BS-1	MT20	3.0	6.0	
O	BMVW-1	MT20	5.0	8.0	
P	BS-1	MT20	3.0	6.0	
Q	BMVW-1	MT20	4.0	4.0	
R	BMVW-1	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS				FACTORED				MAXIMUM FACTORED				INPUT				REQD			
				GROSS REACTION				DOWN				BRG				BRG			
				VERT				HORZ				UPLIFT				IN-SX			
JT				1884	0	1884	0	0	0	0	0	5-8	5-8	5-8	5-8				
R				1884	0	1884	0	0	0	0	0	5-8	5-8	5-8	5-8				

UNFACTORED REACTIONS							
1ST LCASE				MAX. MIN. COMPONENT REACTIONS			
				COMBINED			
				SNOW			
JT				1330	886 / 0	0 / 0	0 / 0
R				1330	886 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.11 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-O, E-O, C-R, I-L

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED				MAX. FACTORED			
MEMB. FORCE (LBS)				MEMB. FORCE (LBS)			
VERT. LOAD LC1				VERT. LOAD LC1			
FROM TO				FROM TO			
A-B	0 : 28	-91.8	-91.8 0.12 (1)	10.00	O-F	0 : 1211	0.27 (1)
B-C	0 : 20	-91.8	-91.8 0.33 (1)	10.00	O-G	-701 0	0.32 (1)
C-D	-2428 / 0	-91.8	-91.8 0.37 (1)	4.11	G-M	0 : 312	0.07 (1)
D-E	-2428 / 0	-91.8	-91.8 0.37 (1)	4.11	M-I	-158 21	0.05 (1)
E-F	-1808 / 0	-91.8	-91.8 0.34 (1)	4.65	E-O	-701 0	0.32 (1)
F-G	-1808 / 0	-91.8	-91.8 0.34 (1)	4.65	O-E	0 312	0.07 (1)
G-H	-2428 / 0	-91.8	-91.8 0.37 (1)	4.11	C-Q	-158 21	0.05 (1)
H-I	-2428 / 0	-91.8	-91.8 0.37 (1)	4.11	R-C	-2717 0	0.55 (1)
I-J	0 20	-91.8	-91.8 0.33 (1)	10.00	I-L	-2717 0	0.55 (1)
J-K	0 28	-91.8	-91.8 0.12 (1)	10.00			
R-B	-325 0	0.0	0.0 0.03 (1)	7.81			
L-J	-325 0	0.0	0.0 0.03 (1)	7.81			
R-O	0 : 2268	-18.5	-18.5 0.51 (1)	10.00			
Q-P	0 : 2051	-18.5	-18.5 0.48 (1)	10.00			
P-O	0 : 2051	-18.5	-18.5 0.48 (1)	10.00			
O-N	0 : 2051	-18.5	-18.5 0.48 (1)	10.00			
N-M	0 : 2051	-18.5	-18.5 0.48 (1)	10.00			
M-L	0 : 2268	-18.5	-18.5 0.51 (1)	10.00			

TOTAL WEIGHT = 3 X 133 = 400 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.08")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.08")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.24")

CSI: TO=0.37/1.00 (G+1), BC=0.51/1.00 (L-M+1), WB=0.55/1.00 (I-L+1), SS=0.20/1.00 (J-K+1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1667 788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

SI GRIP=0.85 (I) (INPUT = 0.90)

SI METAL=0.70 (P) (INPUT = 1.00)

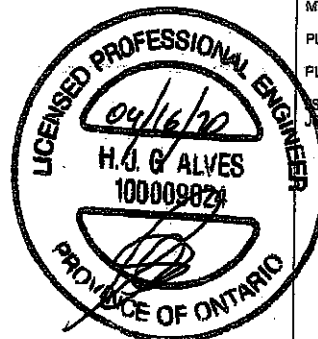


JOB NAME 408188	TRUSS NAME T30	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:26:12 2020 Page 1
IDzqqqs_6XwriBIHcUBaEP9inzQC9m-BUVjZUqWeXt3SgvQ906kPa7EZLeQahQzoYIMC?zPtiqP
5-10-8

Scale = 1:11.8

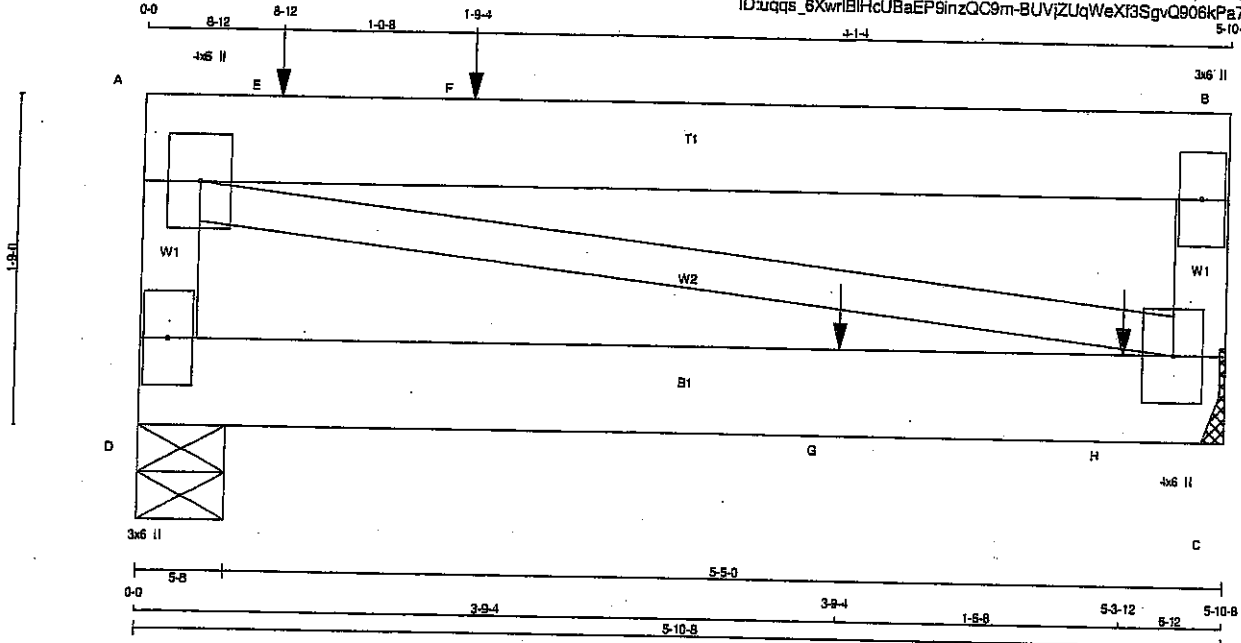

TOTAL WEIGHT = 2 X 27 = 55 lb

LUMBER	DESCR.	SPF
N. L. G. A. RULES		
CHORDS	SIZE	LUMBER
D - A	2x4 DRY	No.2
A - B	2x6 DRY	No.2
C - B	2x4 DRY	No.2
D - C	2x6 DRY	No.2
ALL WEBS	2x3 DRY	No.2
DRY: SEASONED LUMBER.		

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
D-A 1	12	TOP
B-C 1	12	TOP
A-B 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
D-C 2	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE				
A TMVW+p	MT20	4.0	6.0	
B TMV+p	MT20	3.0	6.0	
C 3MVW1+p	MT20	4.0	6.0	
D 3MV1+p	MT20	3.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
JT	GROSS REACTION	GROSS REACTION	BRG	BRG
D	VERT	DOWN	HORZ	UPLIFT
C	1419 0	1419 0	5-8	5-8
	1668 0	1668 0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT C. MINIMUM BEARING LENGTH AT JOINT C = 1-8.

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS
JT COMBINED	
D	999 680.0 0.0 0.0 0.0 0.0 319 0 0 0
C	1173 807.0 0.0 0.0 0.0 0.0 368 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)
FR-TO									
D-A	-1054 0	0.0	0.0	0.05 (1)	7.81	0.0	0.00 (1)		
A-E	0 0	-81.8	-81.8	0.50 (1)	10.00				
E-F	0 0	-81.8	-81.8	0.50 (1)	10.00				
F-B	0 0	-81.8	-81.8	0.50 (1)	10.00				
C-B	-555 0	0.0	0.0	0.03 (1)	7.81				
D-G	0 0	-18.5	-18.5	0.42 (1)	10.00				
G-H	0 0	-18.5	-18.5	0.42 (1)	10.00				
H-C	0 0	-18.5	-18.5	0.42 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	8-12	-211	-211		TOP	VERT	TOTAL		C1
F	1-9-4	-880	-880		TOP	VERT	TOTAL		C1
G	3-9-4	-882	-882		FRONT	VERT	TOTAL		C1
H	5-3-12	-886	-886		FRONT	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 8.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD = 39.0 PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = 1/969 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = 1/732 (0.10")

CSI: TC=0.50/1.00 (A-B:1), BC=0.42/1.00 (C-D:1), WB=0.00/1.00 (A-C:1), SS=0.34/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.14 (A) (INPUT = 0.90)
JSI METAL = 0.07 (D) (INPUT = 1.00)

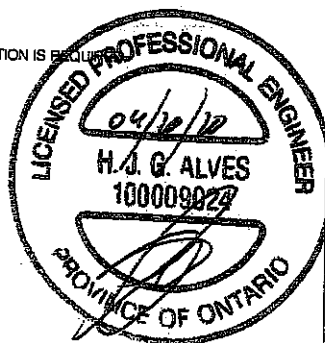

Structural component only

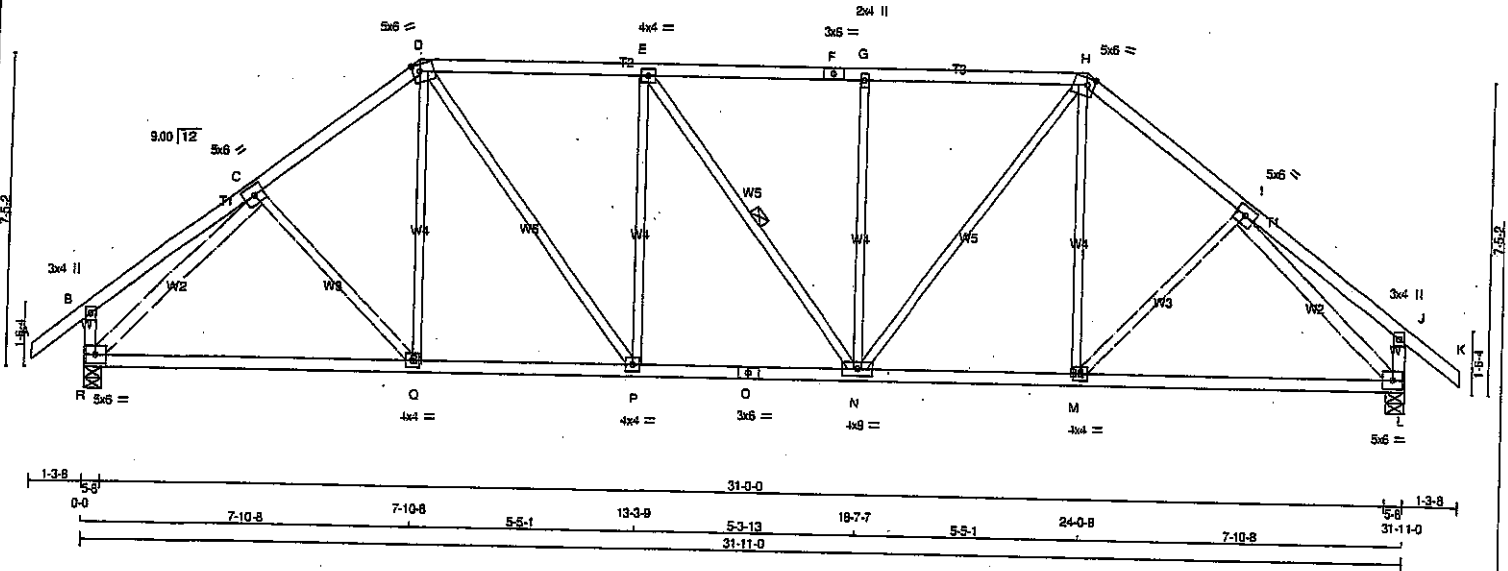

LUMBER

N. L. G. A. RULES

CHORDS SIZE

LUMBER

DESCR.

SPF

DRY: SEASONED LUMBER.

TOTAL WEIGHT = 2 X 148 = 296 lb

N. L. G. A. RULES	CHORDS SIZE	LUMBER	DESCR.	SPF
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - K	2x4	DRY	No.2	SPF
R - S	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
O - O	2x4	DRY	No.2	SPF
O - L	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
R - C	2x4	DRY	No.2	SPF
I - L	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019

- PART 9 OF OBC 2012 (2019 AMENDMENT)

- CSA 086-09, CSA 086-14

- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.06")

CALCULATED VERT. DEFL.(LL) = L/999 (0.08")

ALLOWABLE DEFL.(TL) = L/360 (1.06")

CALCULATED VERT. DEFL.(TL) = L/999 (0.18")

CSI: TC=0.45/1.00 (D-E:1), BC=0.38/1.00 (M-N:1), WB=0.82/1.00 (L-L:1), SS=0.23/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

SI GRIP= 0.89 (I) (INPUT = 0.90)

SI METAL= 0.86 (O) (INPUT = 1.00)

FACTORED GROSS REACTION

MAXIMUM FACTORED DOWN

INPUT BRG

REQD BRG

IN-SX

IN-SX

UNFACTORED REACTIONS

1ST LCASE

MAX. MIN. COMPONENT REACTIONS

COMBINED

SNOW

LIVE

PERM. LIVE

WIND

DEAD

SOIL

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R. L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.34 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS

MEMB.

MAX. FACTORED FORCE (LBS)

FACTORED VERT. LOAD (PLF)

LC1 MAX

MAX. UNBRACED LENGTH

FR-TO


MEMB.

MAX. FACTORED FORCE (LBS)

MAX. UNBRACED LENGTH


FR-TO

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRACED LENGTH	FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	FR-TO
A-B	0.38	-91.8	-91.8	0.12 (1)	10.00	C-Q	0.52	0.02 (4)	
B-C	0.24	-91.8	-91.8	0.22 (1)	10.00	Q-D	0.149	0.05 (4)	
C-D	-1878.0	-91.8	-91.8	0.29 (1)	4.62	D-P	0.777	0.17 (1)	
D-E	-1953.0	-91.8	-91.8	0.45 (1)	4.34	P-E	-533.0	0.53 (1)	
E-F	-1951.0	-91.8	-91.8	0.45 (1)	4.34	E-N	-3.0	0.00 (1)	
F-G	-1951.0	-91.8	-91.8	0.45 (1)	4.34	N-G	-532.0	0.53 (1)	
G-H	-1951.0	-91.8	-91.8	0.45 (1)	4.35	H-H	0.774	0.17 (1)	
H-I	-1878.0	-91.8	-91.8	0.29 (1)	4.62	M-H	0.150	0.05 (4)	
I-J	0.24	-91.8	-91.8	0.22 (1)	10.00	M-I	0.52	0.02 (4)	
J-K	0.38	-91.8	-91.8	0.12 (1)	10.00	R-C	-2149.0	0.82 (1)	
R-S	-266.0	0.0	0.0	0.03 (1)	7.81	I-L	-2149.0	0.82 (1)	
L-J	-266.0	0.0	0.0	0.03 (1)	7.81				
R-Q	0.1479	-18.5	-18.5	0.38 (1)	10.00				
Q-P	0.1482	-18.5	-18.5	0.38 (1)	10.00				
P-O	0.1953	-18.5	-18.5	0.37 (1)	10.00				
O-N	0.1953	-18.5	-18.5	0.37 (1)	10.00				
N-M	0.1482	-18.5	-18.5	0.38 (1)	10.00				
M-L	0.1479	-18.5	-18.5	0.38 (1)	10.00				

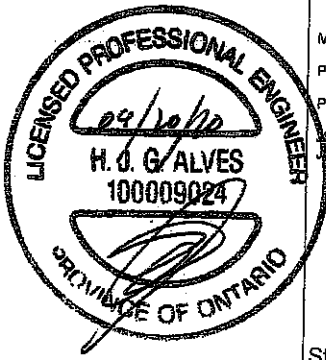

Structural component only

JOB NAME:	TRUSS NAME:	QUANTITY:	PLY:	JOB DESC.:	DRWG NO.:
408188	T33	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

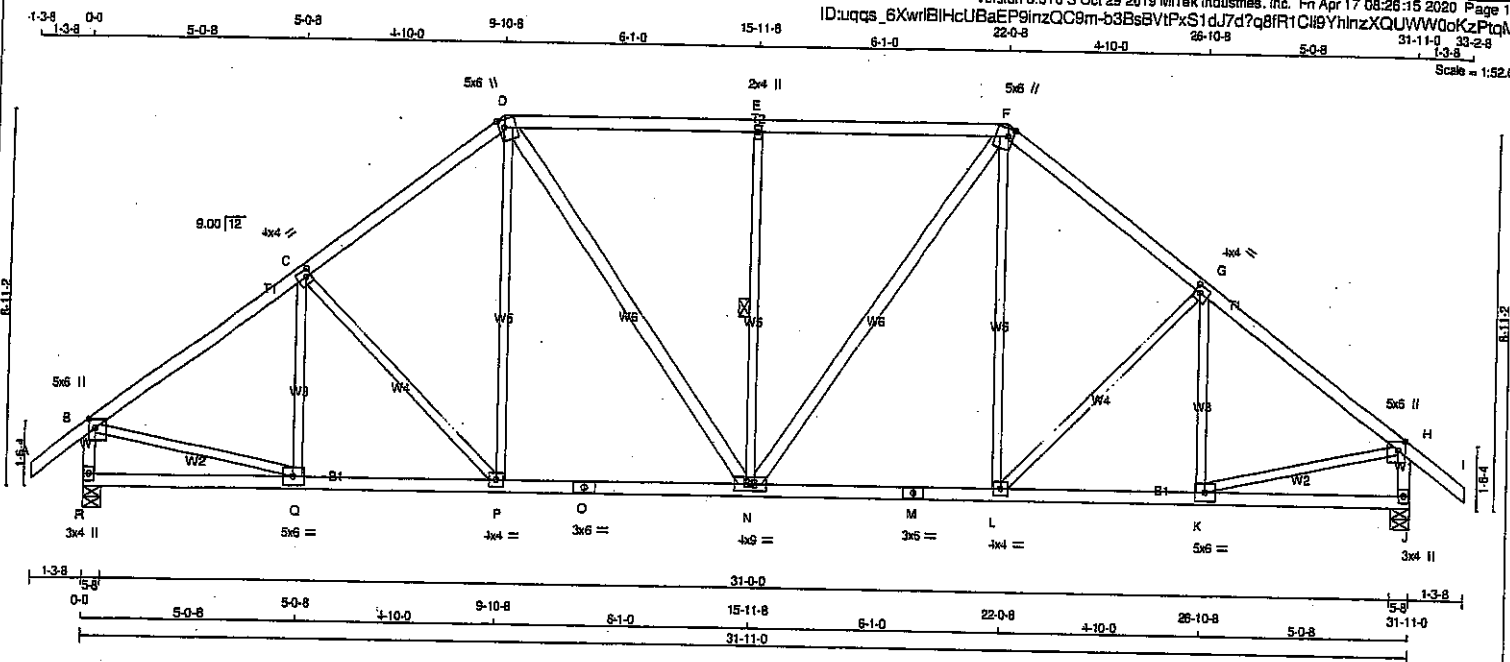

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - B	2x4	DRY	No.2
B - H	2x4	DRY	No.2
H - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	5.0	6.0	2.50 2.00
C	TMVW-i	MT20	4.0	4.0	2.00 1.50
D	TTVW+m	MT20	5.0	6.0	2.25 1.50
E	TMVW-w	MT20	2.0	4.0	
F	TTVW+m	MT20	5.0	6.0	2.25 1.50
G	TMVW-i	MT20	4.0	4.0	2.00 1.50
H	TMVW+p	MT20	5.0	6.0	2.50 2.00
J	BMV1+p	MT20	3.0	4.0	
K	BMVW-i	MT20	5.0	6.0	
L	BMVW-i	MT20	4.0	4.0	
M	BS-i	MT20	3.0	6.0	
N	BMVW-i	MT20	4.0	9.0	
O	BS-i	MT20	3.0	6.0	
P	BMVW-i	MT20	4.0	4.0	
Q	BMVW-i	MT20	5.0	6.0	
R	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	GROSS REACTION	JT	GROSS REACTION	JT	BRG	JT	BRG
R	VERT	R	DOWN	R	IN-SX	R	IN-SX
R	1885 0	R	1885 0	R	5-8	R	5-8
J	1885 0	J	1885 0	J	5-8	J	5-8

UNFACTORED REACTIONS		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	JT	COMBINED
R	1331 887.0	R	1331 887.0
J	1331 887.0	J	1331 887.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.63 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	MEMB.	FORCE (LBS)	MEMB.	FORCE (LBS)	MEMB.	FORCE (LBS)
FR-TO		FR-TO		FR-TO		FR-TO	
A-B	0.38	A-B	0.38	A-B	0.38	A-B	0.38
B-C	-1920.0	B-C	-1920.0	B-C	-1920.0	B-C	-1920.0
C-D	-1780.0	C-D	-1780.0	C-D	-1780.0	C-D	-1780.0
D-E	-1680.0	D-E	-1680.0	D-E	-1680.0	D-E	-1680.0
E-F	-1680.0	E-F	-1680.0	E-F	-1680.0	E-F	-1680.0
F-G	-1780.0	F-G	-1780.0	F-G	-1780.0	F-G	-1780.0
G-H	-1920.0	G-H	-1920.0	G-H	-1920.0	G-H	-1920.0
H-I	0.38	H-I	0.38	H-I	0.38	H-I	0.38
I-B	-1845.0	I-B	-1845.0	I-B	-1845.0	I-B	-1845.0
J-H	-1845.0	J-H	-1845.0	J-H	-1845.0	J-H	-1845.0
R-Q	0.0	R-Q	0.0	R-Q	0.0	R-Q	0.0
Q-P	0.1561	Q-P	0.1561	Q-P	0.1561	Q-P	0.1561
P-O	0.1398	P-O	0.1398	P-O	0.1398	P-O	0.1398
O-N	0.1398	O-N	0.1398	O-N	0.1398	O-N	0.1398
N-M	0.1398	N-M	0.1398	N-M	0.1398	N-M	0.1398
M-L	0.1398	M-L	0.1398	M-L	0.1398	M-L	0.1398
L-K	0.1561	L-K	0.1561	L-K	0.1561	L-K	0.1561
K-J	0.0	K-J	0.0	K-J	0.0	K-J	0.0

TOTAL WEIGHT = 2 X 155 = 310 lb

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL =	25.6 PSF
DL =	6.0 PSF
BOT CH. LL =	0.0 PSF
DL =	7.4 PSF
TOTAL LOAD =	39.0 PSF
SPACING =	24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.06")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (1.06")
CALCULATED VERT. DEFL.(TL) = L/999 (0.13")

CS1: TC=0.48/1.00 (D-E:1), BC=0.31/1.00 (K-L:1), WB=0.36/1.00 (B-Q:1), SS=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES	
PLATE GRIP (DRY)	SHEAR SECTION (PSI) (PL)
MAX MIN	MAX MIN
MT20 618 354	1657 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

SI GRIP = 0.89 (B) (INPUT = 0.90)

SI METAL = 0.46 (C) (INPUT = 1.00)

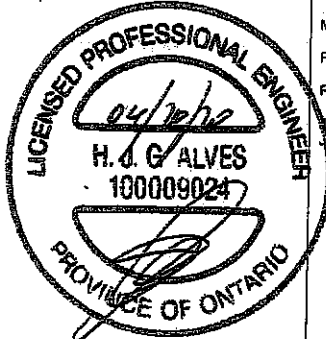


Structural component only

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408188	T34	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Fri Apr 17 08:26:18 2020 Page 1
ID: uqqs_6XwrtBIHcUBaEP9inzQC9m-3FIEOrtIm9UwHCBOsBgaQHvDyOcWPZJAGaLnzPtqL
31-11-0 33-2-8 1-3-8

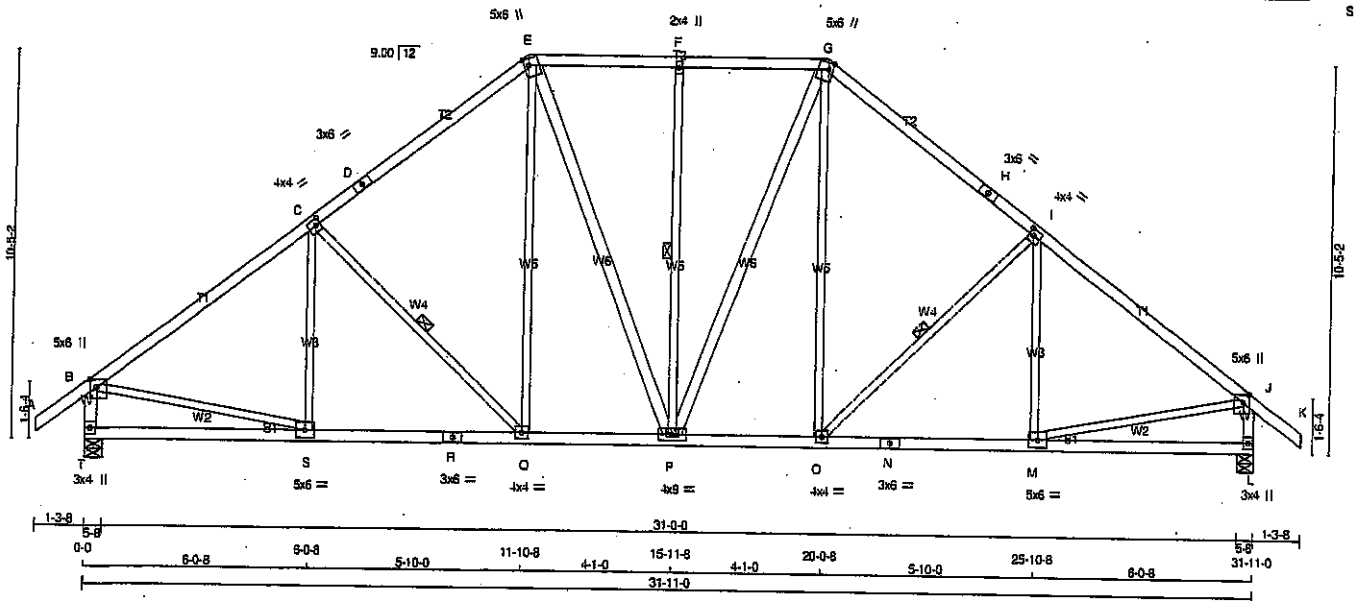

Scale = 1:50.0

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
T - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
T - R	2x4	DRY	No.2
R - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
E - P	2x4	DRY	No.2
P - G	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	2.50	2.00
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TS-t	MT20	3.0	6.0		
E	TTVW+m	MT20	5.0	6.0	2.25	1.50
F	TMVW-w	MT20	2.0	4.0		
G	TTVW+m	MT20	5.0	6.0	2.25	1.50
H	TS-t	MT20	3.0	6.0		
I	TMVW-t	MT20	4.0	4.0	2.00	1.50
J	TMVW+p	MT20	5.0	6.0	2.50	2.00
L	BMV1+p	MT20	3.0	4.0		
M	BMVW-t	MT20	5.0	6.0		
N	BS-t	MT20	3.0	6.0		
O	BMVW-t	MT20	4.0	4.0		
P	BMVW-t	MT20	4.0	4.0		
Q	BMVW-t	MT20	4.0	4.0		
R	BS-t	MT20	3.0	6.0		
S	BMVW-t	MT20	5.0	6.0		
T	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG UPLIFT IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
T	1886	0	1886	0	5-8	5-8
L	1886	0	1886	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE COMBINED		MAX. MIN. COMPONENT REACTIONS		PERM. LIVE WIND	DEAD	SOIL
	SNOW	LIVE					
T	1331	887.0	0.0	0.0	0.0	444.0	0.0
L	1331	887.0	0.0	0.0	0.0	444.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.30 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-Q, F-P, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0.38	-91.8	-91.8 0.12 (1)	10.00	S-C	-189.37	0.11 (1)
B-C	-1942.0	-91.8	-91.8 0.53 (1)	4.30	C-Q	-400.0	0.18 (1)
C-D	-1884.0	-91.8	-91.8 0.48 (1)	4.61	Q-E	0.370	0.08 (1)
D-E	-1884.0	-91.8	-91.8 0.48 (1)	4.61	E-P	0.276	0.04 (1)
E-F	-1404.0	-91.8	-91.8 0.21 (1)	5.29	P-F	-448.0	0.34 (1)
F-G	-1404.0	-91.8	-91.8 0.21 (1)	5.29	P-G	0.276	0.04 (1)
G-H	-1884.0	-91.8	-91.8 0.48 (1)	4.61	O-G	0.370	0.08 (1)
H-I	-1884.0	-91.8	-91.8 0.48 (1)	4.61	O-I	-400.0	0.18 (1)
I-J	-1942.0	-91.8	-91.8 0.53 (1)	4.30	M-I	-189.37	0.11 (1)
J-K	0.38	-91.8	-91.8 0.12 (1)	10.00	B-S	0.1615	0.36 (1)
T-B	-1840.0	0.0	0.0 0.19 (1)	6.17	M-J	0.1615	0.36 (1)
L-J	-1840.0	0.0	0.0 0.19 (1)	6.17			
T-S	0.0	-18.5	-18.5 0.16 (4)	10.00			
S-R	0.1585	-18.5	-18.5 0.34 (1)	10.00			
R-Q	0.1585	-18.5	-18.5 0.34 (1)	10.00			
Q-P	0.1301	-18.5	-18.5 0.26 (1)	10.00			
P-O	0.1301	-18.5	-18.5 0.26 (1)	10.00			
O-N	0.1585	-18.5	-18.5 0.34 (1)	10.00			
N-M	0.1585	-18.5	-18.5 0.34 (1)	10.00			
M-L	0.0	-18.5	-18.5 0.16 (4)	10.00			

TOTAL WEIGHT = 2 X 165 = 331 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN. O.C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.06")
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
ALLOWABLE DEFL.(TL) = L/360 (1.06")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.53/1.00 (B-C:1), BC=0.34/1.00 (Q-S:1), WB=0.36/1.00 (J-M:1), SS=0.21/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (B) (INPUT = 0.90)
JSI METAL = 0.52 (R) (INPUT = 1.00)

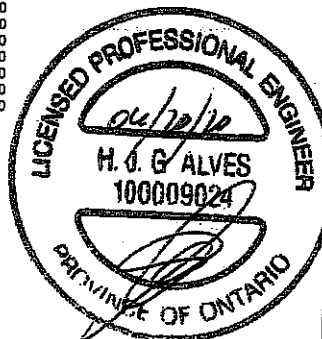

JOB NAME 408188	TRUSS NAME T35	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Fri Apr 17 08:26:17 2020 Page 1	
ID: uqqs_6XwrlBtUbaEP9inzQC9m-XSjccBuft4HLYRnNzZiv6dq4aMFSFqFiyq77tDzPtqf					
Scale = 1:52					

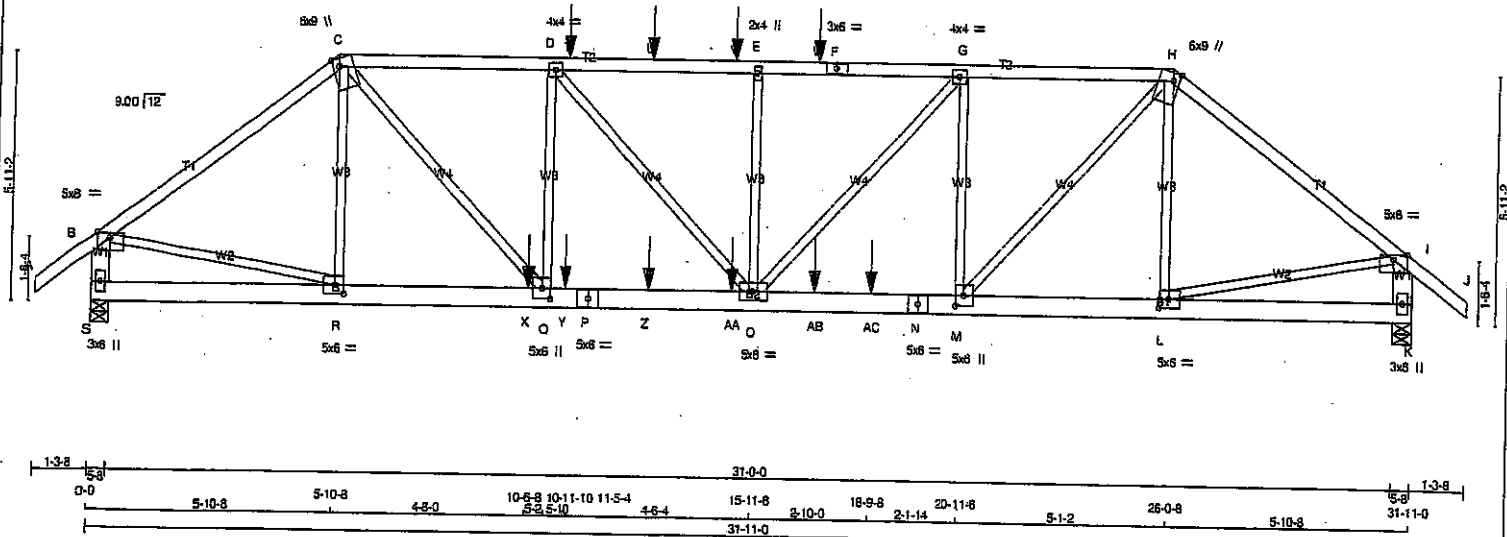

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
S - B	2x6	DRY	No.2
K - I	2x6	DRY	No.2
S - P	2x6	DRY	No.2
P - N	2x6	DRY	No.2
N - K	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	TOP
C - F	12	TOP
F - H	12	TOP
H - J	12	TOP
S - B	2	TOP
K - I	2	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S - P	2	SIDE(0.0)
P - N	2	SIDE(0.0)
N - K	2	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLYS FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (tablets in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMWV-p	MT20	5.0	8.0	Edge
C TTWW-m	MT20	6.0	9.0	Edge 2.00
D TMWW-i	MT20	4.0	4.0	
E TMW-w	MT20	2.0	4.0	
F TS-i	MT20	3.0	6.0	
G TMWV-i	MT20	4.0	4.0	
H TTWW-m	MT20	6.0	9.0	Edge 2.00
I TMWV-p	MT20	5.0	8.0	Edge
K BMV1-p	MT20	3.0	8.0	
L BMWV-i	MT20	5.0	8.0	2.50 2.75
M BMWV-i	MT20	5.0	8.0	3.00 2.25
N BS-i	MT20	5.0	6.0	
O BMWV-i	MT20	5.0	8.0	
P BS-i	MT20	5.0	6.0	
Q BMWV-i	MT20	5.0	6.0	3.00 2.25
R BMWV-i	MT20	5.0	6.0	2.50 2.75
S BMV1-p	MT20	3.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
S	3971	0	0	0	0
K	3551	0	0	0	0

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	2798	1896	0	0	0	0	902	0
K	2503	1693	0	0	0	0	810	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.39 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORZ. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORZ. LOAD (PLF)
FR-TO	FROM						FR-TO			
A-B	0	38	-91.8	-91.8	0.07 (1)	10.00	R-C	-424	0	0.11 (1)
B-C	-4732	0	-91.8	-91.8	0.55 (1)	4.00	C-Q	0	3813	0.47 (1)
C-D	-6354	0	-91.8	-91.8	0.46 (1)	3.52	Q-D	-1192	0	0.31 (1)
D-T	-6736	0	-91.8	-91.8	0.49 (1)	3.39	D-O	0	571	0.07 (1)
T-U	-6736	0	-91.8	-91.8	0.49 (1)	3.39	O-E	-867	0	0.23 (1)
U-V	-6736	0	-91.8	-91.8	0.49 (1)	3.39	E-G	0	1542	0.19 (1)
V-E	-6736	0	-91.8	-91.8	0.49 (1)	3.39	M-H	-1671	0	0.44 (1)
E-W	-6736	0	-91.8	-91.8	0.49 (1)	3.39	H-M	0	3581	0.44 (1)
W-F	-6736	0	-91.8	-91.8	0.49 (1)	3.39	L-H	-632	0	0.18 (1)
F-G	-6736	0	-91.8	-91.8	0.49 (1)	3.39	B-R	0	3844	0.48 (1)
G-H	-5705	0	-91.8	-91.8	0.35 (1)	3.81	L-I	0	3348	0.41 (1)
H-I	-4121	0	-91.8	-91.8	0.50 (1)	4.27				
I-J	0	38	-91.8	-91.8	0.07 (1)	10.00				
S-B	-3944	0	0.0	0.0	0.14 (1)	7.14				
K-I	-3486	0	0.0	0.0	0.13 (1)	7.49				
S-R	0	0	-18.5	-18.5	0.06 (1)	10.00				
R-X	0	3772	-18.5	-18.5	0.44 (1)	10.00				
X-Q	0	3772	-18.5	-18.5	0.44 (1)	10.00				
Q-Y	0	6354	-18.5	-18.5	0.52 (1)	10.00				
Y-P	0	6354	-18.5	-18.5	0.52 (1)	10.00				
P-Z	0	6354	-18.5	-18.5	0.52 (1)	10.00				
Z-AA	0	6354	-18.5	-18.5	0.52 (1)	10.00				
AA-O	0	6354	-18.5	-18.5	0.52 (1)	10.00				
O-AB	0	5705	-18.5	-18.5	0.81 (1)	10.00				
AB-AC	0	5705	-18.5	-18.5	0.81 (1)	10.00				
AC-N	0	5705	-18.5	-18.5	0.81 (1)	10.00				
N-M	0	5705	-18.5	-18.5	0.81 (1)	10.00				
M-L	0	3280	-18.5	-18.5	0.60 (1)	10.00				
L-K	0	0	-18.5	-18.5	0.04 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
T	11-5-4	-178	-178	---	BACK	VERT	TOTAL	---	C1
U	13-5-4	-178	-178	---	BACK	VERT	TOTAL	---	C1
V	15-5-4	-178	-178	---	BACK	VERT	TOTAL	---	C1
W	17-5-4	-178	-178	---	BACK	VERT	TOTAL	---	C1
X	10-6-8	-1649	-1649	---	BACK	VERT	TOTAL	---	C1
Y	11-5-4	-36	-36	---	BACK	VERT	TOTAL	---	C1
Z	13-5-4	-36	-36	---	BACK	VERT	TOTAL	---	C1
AA	15-5-4	-36	-36	---	BACK	VERT	TOTAL	---	C1

TOTAL WEIGHT = 2 X 158 = 316 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.06")

CALCULATED VERT. DEFL. (LL) = L/999 (0.16")

ALLOWABLE DEFL. (TL) = L/360 (1.06")

CALCULATED VERT. DEFL. (TL) = L/999 (0.29")

CSI: TC=0.55/1.00 (B-C:1), BC=0.81/1.00 (M-O:1)

WB=0.48/1.00 (B-R:1), SS=0.51/1.00 (Q-R:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.86 (Q) (INPUT = 0.80)

JSI METAL = 0.63 (N) (INPUT = 1.00)

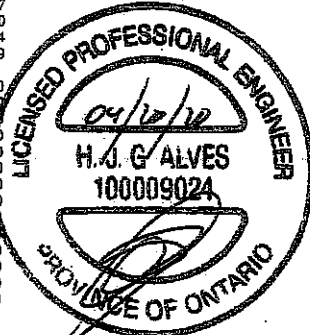


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408188	T37	1	1	TRUSS DESC.		

Tamarack Road Truss, Burlington

Version 8.310 S Oct 29 2018 MITek Industries, Inc. Fri Apr 17 08:26:19 2020 Page 1
ID:uqqs_6XwrlBIHcUBaEP9inzQC9m-UqQN1twv?hX3nlxm3_kNC2vTR95JlqP?P8UEySzPtqj

Scale = 1:40.1

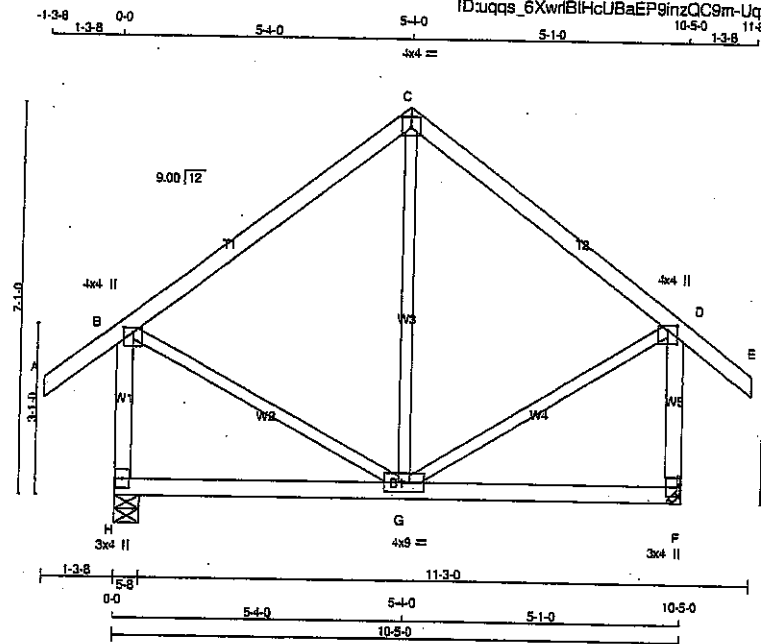

LUMBER				DESIGN CRITERIA			
N. L. G. A. RULES				TOTAL WEIGHT = 51 lb			
CHORDS	SIZE	LUMBER	DESCR.	SPECIFIED LOADS:			
A - C	2x4	DRY	No.2	TOP CH. LL = 25.6 PSF			
C - E	2x4	DRY	No.2	DL = 6.0 PSF			
H - B	2x4	DRY	No.2	BOT CH. LL = 0.0 PSF			
F - D	2x4	DRY	No.2	DL = 7.4 PSF			
H - F	2x4	DRY	No.2	TOTAL LOAD = 39.0 PSF			

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTW+p	MT20	4.0	4.0	2.25	2.00
D	TMVW+p	MT20	4.0	4.0	1.00	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW+I	MT20	4.0	9.0		
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
		GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	UP/LIFT	IN-SX	IN-SX
H	701	0	701	0	5-8
F	701	0	701	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	493	337.0	0.0	0.0	0.0	156.0	0.0
F	493	337.0	0.0	0.0	0.0	156.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)
FR-TO		FROM	TO		FR-TO			FR-TO	
A-B	0.38	-91.8	-91.8	0.12 (1)	10.00	G-C	-133	41	0.11 (1)
B-C	-287.0	-91.8	-91.8	0.33 (1)	6.25	B-G	0	259	0.08 (1)
C-D	-287.0	-91.8	-91.8	0.30 (1)	6.25	G-D	0	266	0.06 (1)
D-E	0.38	-91.8	-91.8	0.12 (1)	10.00				
H-B	-663.0	0.0	0.0	0.11 (1)	7.81				
F-D	-665.0	0.0	0.0	0.12 (1)	7.81				
H-G	0.0	-18.5	-18.5	0.14 (4)	10.00				
G-F	0.0	-18.5	-18.5	0.14 (4)	10.00				

THIS TRUSS COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L' 999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L' 999 (0.02")

CSI: TC=0.33/1.00 (B-C:1), BC=0.14/1.00 (F-G:4),
WB=0.11/1.00 (C-G:1), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.53 (B) (INPUT = 0.99)
JSI METAL = 0.13 (B) (INPUT = 1.00)

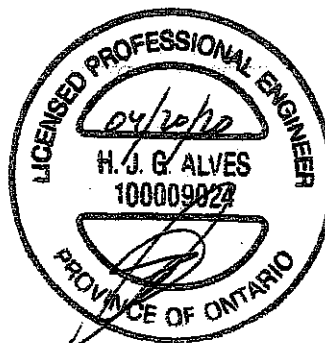

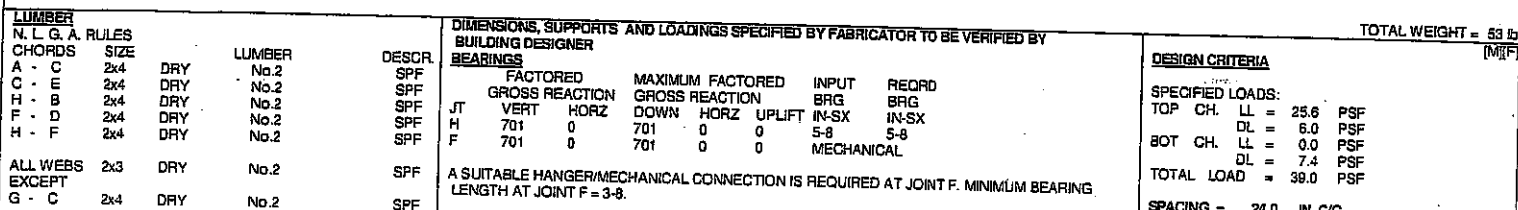

DRY: SEASONED LUMBER

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TMTMW+p	MT20	4.0	4.0	Edge	
D	TMVW+p	MT20	4.0	4.0	1.00	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVW/W-l	MT20	4.0	9.0		
H	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
H	701	0	701	0	0	5-8	5-8
F	701	0	701	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3-8

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	493	337 0	0 0	0 0	0 0	156 0	0 0
F	493	337 0	0 0	0 0	0 0	156 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSl (LC)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX CSl (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 38	-91.8	-91.8 0.12 (1)	10.00	B-G	0 259	0.08 (1)
B-C	-287 0	-91.8	-91.8 0.38 (1)	6.25	G-D	0 266	0.06 (1)
C-D	-287 0	-91.8	-91.8 0.30 (1)	6.25	G-C	-133 41	0.08 (1)
D-E	0 38	-91.8	-91.8 0.12 (1)	10.00			
H-B	-652 0	0.0	0.0 0.11 (1)	7.81			
F-D	-655 0	0.0	0.0 0.12 (1)	7.81			
H-G	0 0	-18.5	-18.5 0.14 (4)	10.00			
G-F	0 0	-18.5	-18.5 0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018 , OBC 2012 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.02")

CSI: TC=0.33/1.00 (B-C:1), BC=0.14/1.00 (G-H:4),
WB=0.08/1.00 (C-G:1), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.53 (B) (INPUT = 0.90)
JSI METAL= 0.13 (B) (INPUT = 1.00)

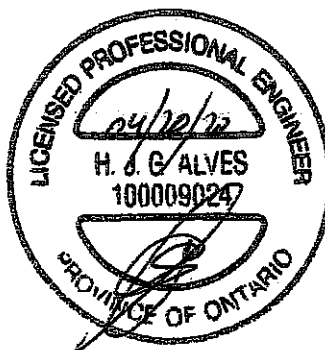


Structural component only

Tamarack Hoop Truss, Burlington

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Fri Apr 17 08:26:22 2020 Page 1
cUBaEP9inzQC9m-uP6VfyofcvefCgLk6H4phX_UN3sw6DS56juYQZpTq

Scale: 3000'

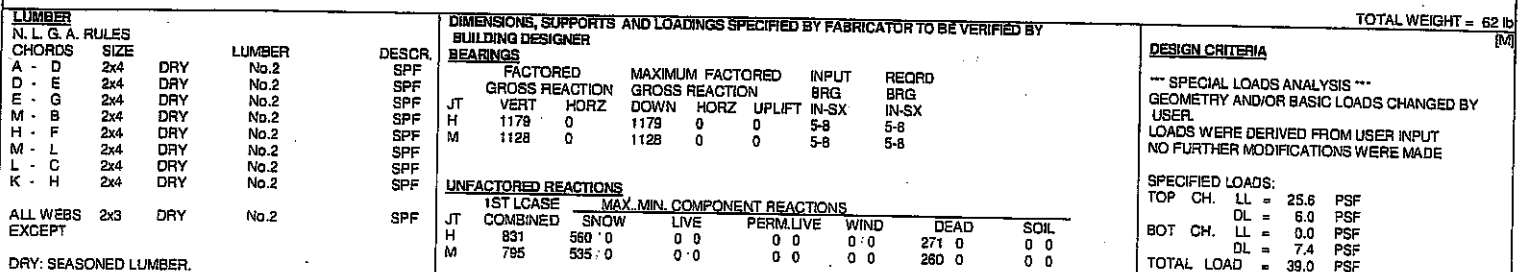

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVV-p	MT20	5.0	6.0	2.00	2.75
C	TMVV-p	MT20	5.0	6.0	2.00	2.00
D	TMVV+m	MT20	5.0	6.0	1.25	1.50
E	TTW-m	MT20	4.0	4.0		
F	TMVV+p	MT20	4.0	6.0	Edge	
H	BMV1+p	MT20	3.0	4.0		
I	BMVVV-t	MT20	4.0	9.0		
J	BMVV-t	MT20	4.0	6.0		
K	BMVVV-t	MT20	4.0	9.0	2.75	5.75
L	BMV-p	MT20	3.0	4.0		
M	BMVVV-t	MT20	4.0	9.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
H	1179	0	1179	0	0	5-8	5-8
M	1128	0	1128	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	831	560.0	0.0	0.0	0.0	271.0	0.0
M	795	535.0	0.0	0.0	0.0	260.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H. M.

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.55 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: 141

CHORDS				WEB S			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LG1 (PLP)	MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0.38	-91.8	-91.8 0.14 (1)	10.00	C-J	-843.0	0.21 (1)
B-N	-2074.0	-91.8	-91.8 0.15 (1)	4.55	J-D	0.374	0.09 (1)
N-C	-2074.0	-91.8	-91.8 0.15 (1)	4.55	D-I	-269.0	0.12 (1)
C-O	-1200.0	-91.8	-91.8 0.18 (1)	5.50	I-E	0.98	0.04 (4)
O-D	-1200.0	-91.8	-91.8 0.18 (1)	5.50	J-F	0.834	0.21 (1)
D-P	-792.0	-91.8	-91.8 0.35 (1)	6.25	M-K	-54.0	0.01 (1)
P-E	-792.0	-91.8	-91.8 0.35 (1)	6.25	B-K	0.1730	0.43 (1)
E-F	-591.0	-91.8	-91.8 0.23 (1)	5.96			
F-G	0.38	-91.8	-91.8 0.14 (1)	10.00			
M-B	-1071.0	0.0	0.0 0.12 (1)	7.58			
H-F	-1148.0	0.0	0.0 0.13 (1)	7.39			
M-Q	0.44	-18.5	-18.5 0.05 (4)	10.00			
Q-L	0.44	-18.5	-18.5 0.05 (4)	10.00			
L-K	0.29	0.0	0.0 0.13 (1)	10.00			
K-C	0.509	0.0	0.0 0.21 (1)	10.00			
K-R	0.1741	-18.5	-18.5 0.35 (1)	10.00			
R-S	0.1741	-18.5	-18.5 0.35 (1)	10.00			
S-J	0.1741	-18.5	-18.5 0.35 (1)	10.00			
T-T	0.978	-18.5	-18.5 0.21 (1)	10.00			
T-I	0.978	-18.5	-18.5 0.21 (1)	10.00			
I-U	0.0	-18.5	-18.5 0.08 (4)	10.00			
U-H	0.0	-18.5	-18.5 0.08 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
	5-9-8	-128	-128	---	FRONT	VERT	TOTAL	---	C1
	9-8-8	-206	-206	---	FRONT	VERT	TOTAL	---	C1
	9-5-12	-13	-13	---	FRONT	VERT	TOTAL	---	C1
	2-4-0	-9	-10	---	FRONT	VERT	DEAD	---	C1
	2-4-0	-41	-41	---	FRONT	VERT	SNOW	---	C1
	5-5-12	-98	-98	---	FRONT	VERT	TOTAL	---	C1
	7-5-12	-67	-67	---	FRONT	VERT	TOTAL	---	C1
	1-5-12	-3	-3	---	FRONT	VERT	TOTAL	---	C1
	3-5-12	-15	-15	---	FRONT	VERT	TOTAL	---	C1
	5-5-12	-13	-13	---	FRONT	VERT	TOTAL	---	C1
	7-5-12	-13	-13	---	FRONT	VERT	TOTAL	---	C1
	10-11-4	-13	-13	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

DESIGN CRITERIA

--- SPECIAL LOADS ANALYSIS ---
GEOMETRY AND/OR BASIC LOADS CHANGED BY
USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 6.00/12

*** NON STANDARD GIRDER ***
ADDT'L USER-DEFINED LOADS APPLIED TO ALL
LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(56 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL(LL)= L/360 (0.43")
CALCULATED VERT. DEFL(LL) = L/999 (10.04")
ALLOWABLE DEFL(TL)= L/360 (0.43")
CALCULATED VERT. DEFL(TL) = L/999 (10.07")

CSI: TC=0.35,1.00 (D-E:1) , BC=0.35,1.00 (J-K:1) ,
WB=0.43,1.00 (B-K:1) , SSI=0.18,1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES					
PLATE	GRIP(DRY)		SHEAR		SECTION
	(PSI)		(PLI)		(PLI)
	MAX	MIN	MAX	MIN	MAX
MT20	618	354	1667	788	1987

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.86 (K) (INPUT = 0.90)
JSI METAL= 0.51 (F) (INPUT = 1.00)

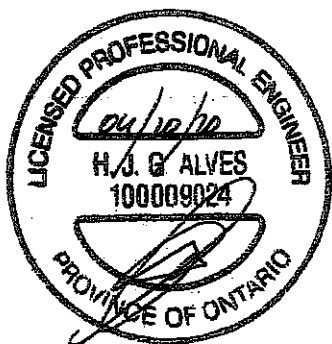

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408188	T39	5	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 08:26:23 2020 Page 1
ID: uqqs_6XwrlBIHcUBaEP9inzQC9m-McqusEzQ2w1VGMEXlqpJMu49PmQ4laSbKrnSR5tzPta

Scale = 1/4"

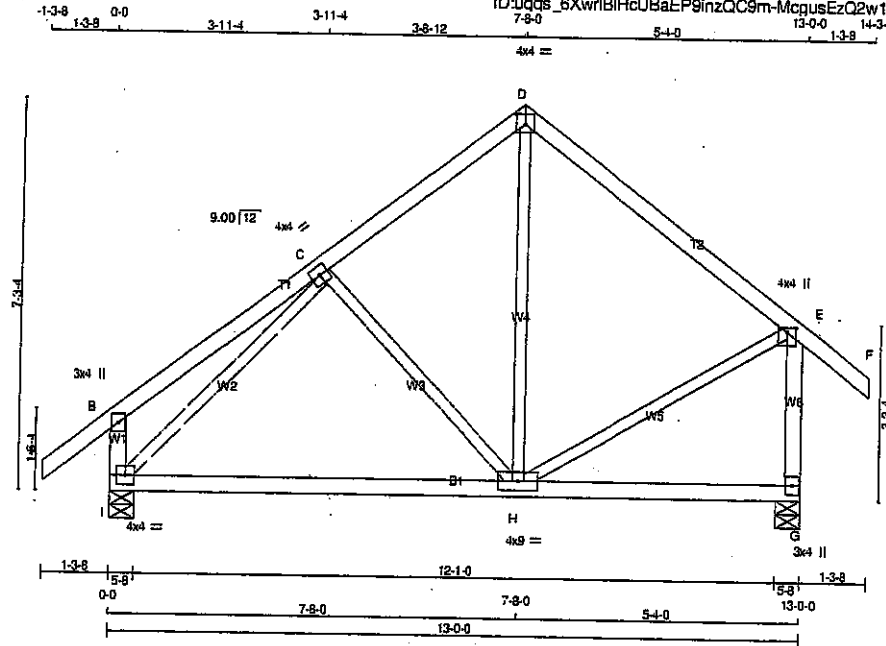

LUMBER				BEARINGS				DESIGN CRITERIA			
N. L. G. A. RULES	SIZE	DRY	LUMBER	DESCR.	SPF	FACTORED	MAXIMUM FACTORED	INPUT	REQD	TOTAL WEIGHT = 5 X 61 = 303 lb	
CHORDS	2x4	DRY	No.2	SPF	SPF	GROSS REACTION	GROSS REACTION	BRG	BRG	SPECIFIED LOADS:	
A - D	2x4	DRY	No.2	SPF	SPF	VERT	DOWN	IN-SX	IN-SX	TOP CH. LL = 25.6 PSF	
I - B	2x4	DRY	No.2	SPF	SPF	HORZ	HORZ	5-8	5-8	DL = 8.0 PSF	
G - E	2x4	DRY	No.2	SPF	SPF					BOT CH. LL = 0.0 PSF	
I - G	2x4	DRY	No.2	SPF	SPF					DL = 7.4 PSF	

ALL WEBS 2x3 DRY No.2	SPF	UNFACTORED REACTIONS	DESIGN CRITERIA			
EXCEPT		1ST CASE	THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR			
DRY: SEASONED LUMBER.		MAX. MIN. COMPONENT REACTIONS	SMALL BUILDING REQUIREMENTS OF PART 9,			
			NBCC 2010, NBCC 2015			

PLATES (table is in inches)				BRACING				LOADING			
JT TYPE	PLATES	W	LEN Y X	JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B TMV+p	MT20	3.0	4.0	I	584	403 0	0 0	0 0	0 0	191 0	0 0
C TMVW-t	MT20	4.0	4.0	G	594	403 0	0 0	0 0	0 0	191 0	0 0
D TTW-p	MT20	4.0	4.0								
E TMVW+p	MT20	4.0	4.0								
G BMV1+p	MT20	3.0	4.0								
H BMVWV-t	MT20	4.0	9.0								
I BMVW1-t	MT20	4.0	4.0								

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	MAX. FACTORED	MEMB.	MAX. FACTORED	FACTORED	MAX. FACTORED
	FORCE (LBS)	VERT. LOAD (LBS)	CS (LC)		FORCE (LBS)	CS (LC)	CS (LC)
FR-TO		FROM	TO	FR-TO			
A-B	0 38	-91.8	-91.8 0.12 (1)	C-H	-226 0	0.12 (1)	
B-C	0 25	-91.8	-91.8 0.22 (1)	H-D	0 129	0.04 (4)	
C-D	-449 0	-91.8	-91.8 0.17 (1)	I-C	-722 0	0.37 (1)	
D-E	-424 0	-91.8	-91.8 0.34 (1)	H-E	0 387	0.09 (1)	
E-F	0 38	-91.8	-91.8 0.12 (1)				
I-B	-280 0	0.0	0.0 0.03 (1)				
G-E	-813 0	0.0	0.0 0.15 (1)				
I-H	0 495	-18.5	-18.5 0.28 (4)				
H-G	0 0	-18.5	-18.5 0.25 (4)				


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP (DRY)	SHEAR	SECTION	
(PS)	(PL)	(PL)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1667 788	1987 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.68 (C) (INPUT = 0.90)
JSI METAL = 0.28 (C) (INPUT = 1.00)

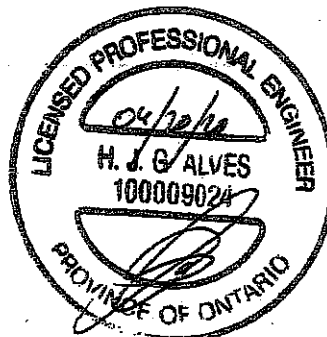

JOB NAME 408189	TRUSS NAME T51	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 06:26:21 2020 Page 1
 ID:9MBR3O?wfaGdNA/gbwW9RzQAof-vJoUdbORGAviQUGDCcw_8nyJZLkui?_zT72hd1zPtoC

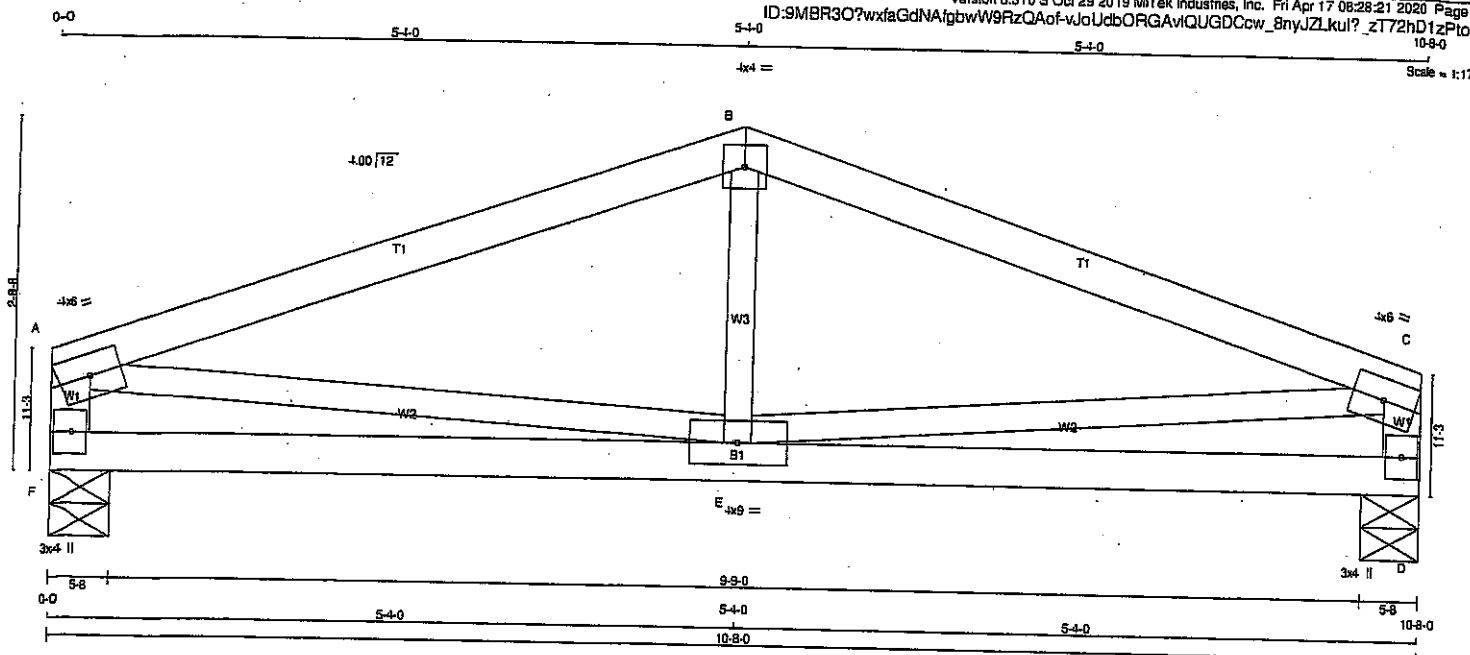

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
F - A	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW-t	MT20	4.0	6.0	
B	TTW-p	MT20	4.0	4.0	
C	TMVW-t	MT20	4.0	6.0	
D	BMV1-p	MT20	3.0	4.0	
E	BMVWW-I	MT20	4.0	9.0	
F	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REORD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
F	588	0	588	0	0	5-8	5-8
D	588	0	588	0	0	5-8	5-8

UNFACTORED REACTIONS		MAX. MIN. COMPONENT REACTIONS	
JT	1ST CASE	SNOW	LIVE
F	416	273 / 0	0.0
D	416	273 / 0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, D

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSF (LC)	MEMB.	FORCE (LBS)	MAX. CSF (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	-708 / 0	-91.8 -91.8	0.34 (1)	6.25	E-B	-42 / 77	0.03 (4)
B-C	-708 / 0	-91.8 -91.8	0.34 (1)	6.25	A-E	0 / 676	0.15 (1)
F-A	-548 / 0	0.0 0.0	0.05 (1)	7.81	E-C	0 / 676	0.15 (1)
D-C	-548 / 0	0.0 0.0	0.05 (1)	7.81			
F-E	0 / 0	-18.5 -18.5	0.14 (4)	10.00			
E-D	0 / 0	-18.5 -18.5	0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.36")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
 ALLOWABLE DEFL.(TL) = L/360 (0.36")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSF: TO=0.34/1.00 (B-C:1), BC=0.14/1.00 (E-F:4), WB=0.15/1.00 (A-E:1), SS=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1867
			788
			1987
			1856

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


SSI GRIP = 0.39 (C) (INPUT = 0.90)
 JST METAL = 0.19 (C) (INPUT = 1.00)

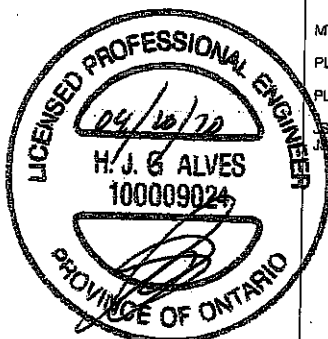

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408189	T51Z	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 08:28:22 2020 Page 1
ID:9M8R3O?wxfaGdNAfgbwW9RzQAof-NVMtrXP31U1c2erPmJRDh_VV7kzK1QE6hnnFmTzPtoN
10-8-0
Scale = 1:17.0

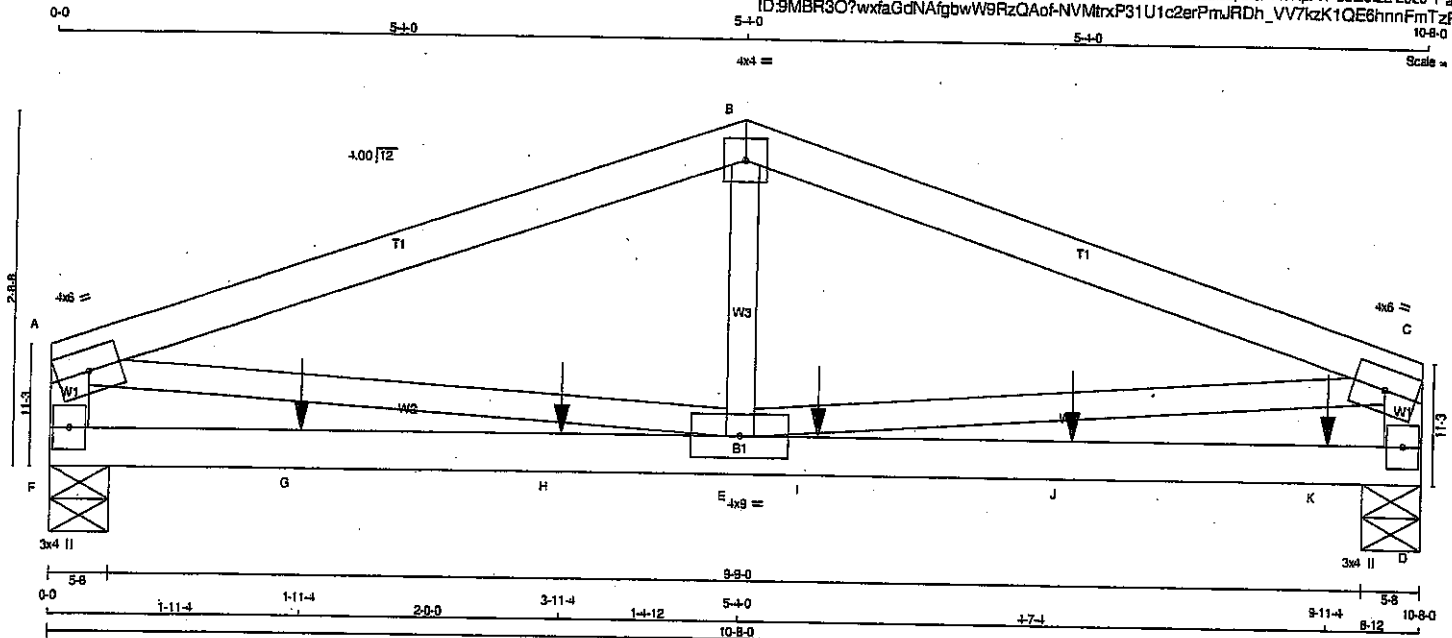

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4 DRY	No.2	SPF		
B - C	2x4 DRY	No.2	SPF		
F - A	2x4 DRY	No.2	SPF		
D - C	2x4 DRY	No.2	SPF		
F - D	2x4 DRY	No.2	SPF		
ALL WEBS	2x3 DRY	No.2	SPF		
EXCEPT					

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - B	12	TOP
B - C	12	TOP
F - A	12	TOP
D - C	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	4.0	6.0		
B	TTW-p	MT20	4.0	4.0		
C	TMVW-t	MT20	4.0	6.0		
D	BMV1-p	MT20	3.0	4.0		
E	BMVWW-t	MT20	4.0	9.0		
F	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
F	1438	0	1438	0	5-8	5-8
D	1912	0	1912	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
F	1010	703	0	0	0	307	0
D	1341	943	0	0	0	399	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.48 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		MAX. UNBRACED LENGTH	MEMB.	WEBS	
	MAX. FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX	LC2 MAX			MAX. FORCE (LBS)	MAX. CSI (LC)
FR-TO						FR-TO		
A-B	-2375	0	-91.8	-91.8	0.29 (1)	E-B	0	1013
B-C	-2375	0	-91.8	-91.8	0.29 (1)	A-E	0	2269
F-A	-1283	0	0.0	0.0	0.07 (1)	E-C	0	2269
D-C	-1283	0	0.0	0.0	0.07 (1)			
F-G	0	0	-18.5	-18.5	0.58 (1)			
G-H	0	0	-18.5	-18.5	0.58 (1)			
H-E	0	0	-18.5	-18.5	0.58 (1)			
E-I	0	0	-18.5	-18.5	0.58 (1)			
I-J	0	0	-18.5	-18.5	0.58 (1)			
J-K	0	0	-18.5	-18.5	0.58 (1)			
K-D	0	0	-18.5	-18.5	0.58 (1)			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	1-11-4	-255	-255		TOP	VERT	TOTAL		C1
H	3-11-4	-387	-387		TOP	VERT	TOTAL		C1
I	5-11-4	-507	-507		FRONT	VERT	TOTAL		C1
J	7-11-4	-507	-507		FRONT	VERT	TOTAL		C1
K	9-11-4	-509	-509		FRONT	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.36")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (0.36")
CALCULATED VERT. DEFL.(TL) = L/679 (0.19")

CSI: TC=0.29/1.00 (B-C:1), BC=0.58/1.00 (E-F:1),
WB=0.28/1.00 (A-E:1), SS=0.42/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.65 (C) (INPUT = 0.90)
JSI METAL= 0.30 (A) (INPUT = 1.00)

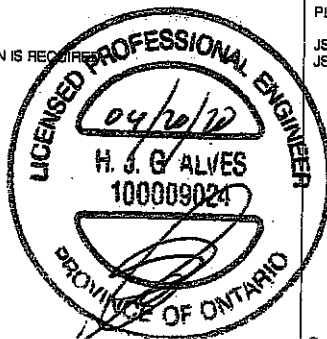

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408189	T53	4	1	GREEN PARK HOMES		
Tamarack Roof Truss, Burlington						

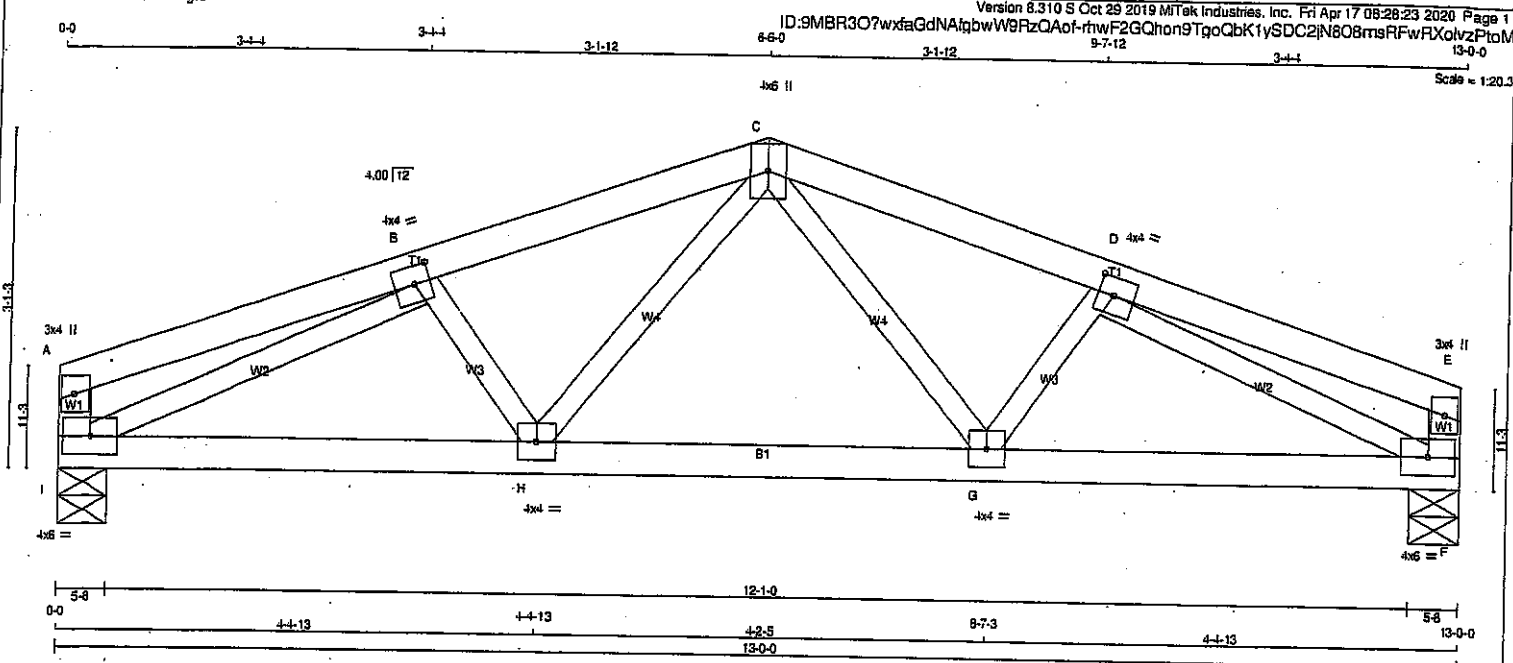

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				TOTAL WEIGHT = 4 X 45 = 181 lb			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	FACTORED	MAXIMUM FACTORED	INPUT	REQD			
A - C	2x4	DRY	No.2	SPF	GROSS REACTION	GROSS REACTION	BRG	BRG			
C - E	2x4	DRY	No.2	SPF	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
I - A	2x4	DRY	No.2	SPF	I	717	0	717	0	5-8	5-8
F - E	2x4	DRY	No.2	SPF	F	717	0	717	0	5-8	5-8
I - F	2x4	DRY	No.2	SPF							
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF							

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B	TMWW-t	MT20	4.0	4.0	2.00	1.75
C	TTWW+p	MT20	4.0	6.0		
D	TMWW-t	MT20	4.0	4.0	2.00	1.75
E	TMV+p	MT20	3.0	4.0		
F	BMVW1-t	MT20	4.0	6.0		
G	BMWW-t	MT20	4.0	4.0		
H	BMWW-t	MT20	4.0	4.0		
I	BMVW1-t	MT20	4.0	6.0		

UNFACTORED REACTIONS

JT	1ST CASE	MAX-MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	507	333 0	0 0	0 0	0 0	0 0	174 0	0 0
F	507	333 0	0 0	0 0	0 0	0 0	174 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.04 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0.9	-91.8 -91.8	0.13 (1)	10.00	C-G	0.250	0.08 (1)
B-C	-1042.0	-91.8 -91.8	0.11 (1)	8.04	G-D	-148.4	0.02 (1)
C-D	-1042.0	-91.8 -91.8	0.11 (1)	8.04	H-C	0.250	0.08 (1)
D-E	0.9	-91.8 -91.8	0.13 (1)	10.00	B-H	-148.4	0.02 (1)
I-A	-122.0	0.0 0.0	0.01 (1)	7.81	I-B	-1198.0	0.28 (1)
F-E	-122.0	0.0 0.0	0.01 (1)	7.81	D-F	-1198.0	0.28 (1)
I-H	0.1061	-18.5 -18.5	0.22 (1)	10.00			
H-G	0.824	-18.5 -18.5	0.16 (1)	10.00			
G-F	0.1061	-18.5 -18.5	0.22 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 8.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.43")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.43")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.13/1.00 (D-E:1), SC=0.22/1.00 (F-G:1),
WB=0.28/1.00 (D-F:1), SS=0.13/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX	MIN	MAX
MT20	618	354
	1687	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.79 (B) (INPUT = 0.90)
JSI METAL= 0.43 (B) (INPUT = 1.00)

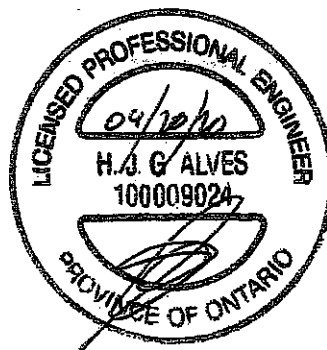

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408189	T53Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:28:25 2020 Page 1
ID:9MBR3O?wxlaGdNAIgbwW9RzQAof-q42?TyRyKPPBv6Z_RS?wid73_yzUEIYNIOWNozPtoP

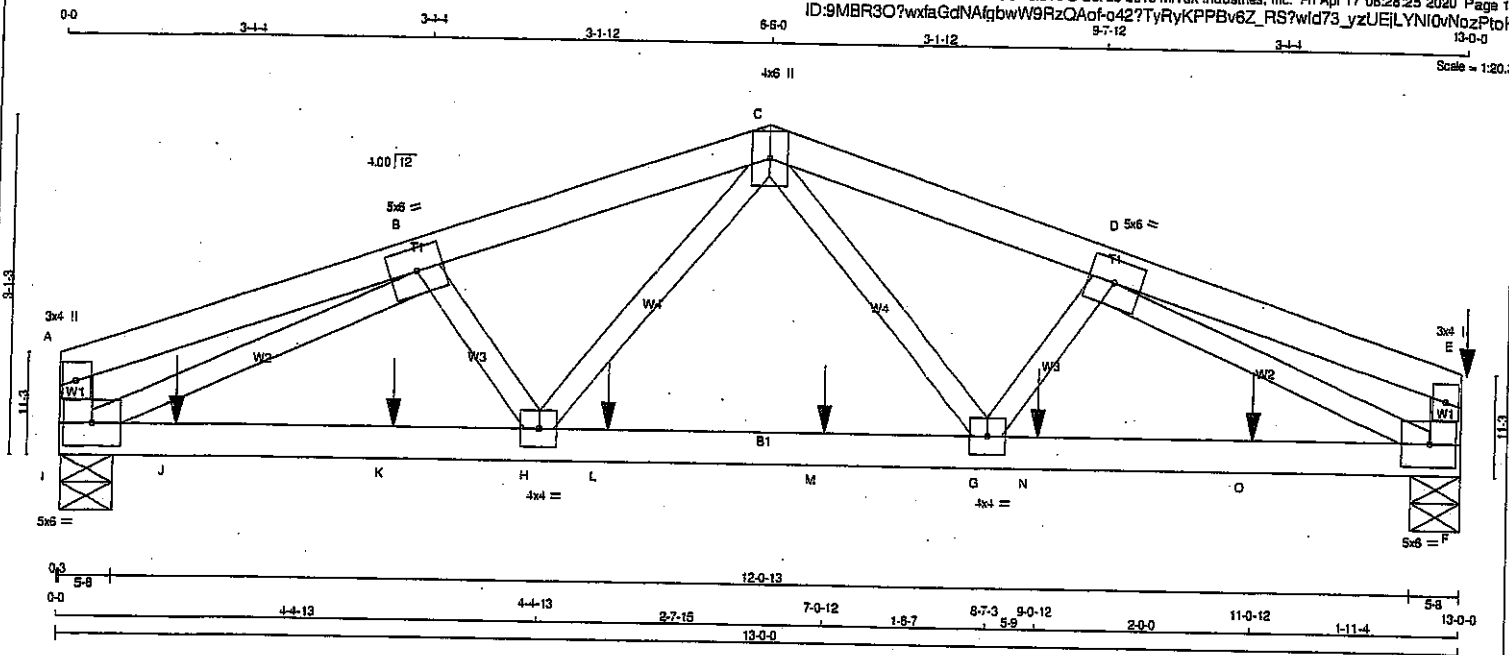

TOTAL WEIGHT = 2 X 45 = 91 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
F - A	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
F - F	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	TOP
C - E	12	TOP
F - A	12	TOP
F - E	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - F	12	SIDE (0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0	
B	TMWW-1	MT20	5.0	6.0	
C	TTWW+p	MT20	4.0	6.0	
D	TMWW-1	MT20	5.0	6.0	
E	TMV+p	MT20	3.0	4.0	
F	BMVW1-1	MT20	5.0	6.0	
G	BMWW-1	MT20	4.0	4.0	
H	BMWW-1	MT20	4.0	4.0	
I	BMVW1-1	MT20	5.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	UP/LIFT
I	2267	0	2267	0
F	2267	0	2267	0

UNFACTORED REACTIONS

JT	1ST LOASE COMBINED	MAX. MIN. SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	1590	1118	0	0.0	0.0	471	0
F	1596	1135	0	0.0	0.0	451	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.91 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRACED LENGTH	MEMB.	WEBS MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO			FR-TO		
A-B	0/3	-91.8	-91.8	0.08 (1)	10.00	C-G	0.956
B-C	-3507/0	-91.8	-91.8	0.12 (1)	4.91	G-D	0.239
C-D	-3247/0	-91.8	-91.8	0.11 (1)	5.07	H-C	0.1370
D-E	0/4	-91.8	-91.8	0.08 (1)	10.00	B-H	0.286
F-A	-140/0	0.0	0.0	0.01 (1)	7.81	I-B	-3580.0
F-E	-559/0	0.0	0.0	0.03 (1)	7.81	D-F	-3329.0
I-J	0/3188	-18.5	-18.5	0.68 (1)	10.00		
J-K	0/3188	-18.5	-18.5	0.68 (1)	10.00		
K-H	0/3188	-18.5	-18.5	0.68 (1)	10.00		
H-L	0/2503	-18.5	-18.5	0.62 (1)	10.00		
L-M	0/2503	-18.5	-18.5	0.62 (1)	10.00		
M-G	0/2503	-18.5	-18.5	0.62 (1)	10.00		
G-N	0/2946	-18.5	-18.5	0.50 (1)	10.00		
N-O	0/2946	-18.5	-18.5	0.50 (1)	10.00		
O-F	0/2946	-18.5	-18.5	0.50 (1)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	TOTAL
E	13-0-0	-421	-421	---	TOP	VERT	TOTAL	
J	1-0-12	-507	-507	---	FRONT	VERT	TOTAL	
K	3-0-12	-507	-507	---	FRONT	VERT	TOTAL	
L	5-0-12	-507	-507	---	FRONT	VERT	TOTAL	
M	7-0-12	-507	-507	---	FRONT	VERT	TOTAL	
N	9-0-12	-387	-387	---	TOP	VERT	TOTAL	
O	11-0-12	-265	-265	---	TOP	VERT	TOTAL	

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.43")
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
ALLOWABLE DEFL.(TL) = L/360 (0.43")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CS1: TC=0.12/1.00 (B-C:1), BC=0.68/1.00 (H-I:1), WB=0.45/1.00 (B-I:1), SS1=0.30/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.90 (F) (INPUT = 0.90)


JSI METAL= 0.45 (D) (INPUT = 1.00)

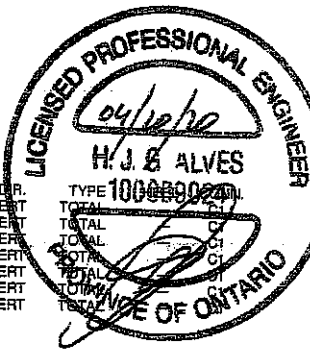

Structural component only

JOB NAME 408189	TRUSS NAME T55	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 28 2019 MITek Industries, Inc. Fri Apr 17 08:28:26 2020 Page 1
ID:9MBR3O7wxfGdNAfgbwW9RzQAof-GGBhNhsa5IX2XF8A79W9rqgCNMQmzEBicPISvEzPtoJ
10-8-0

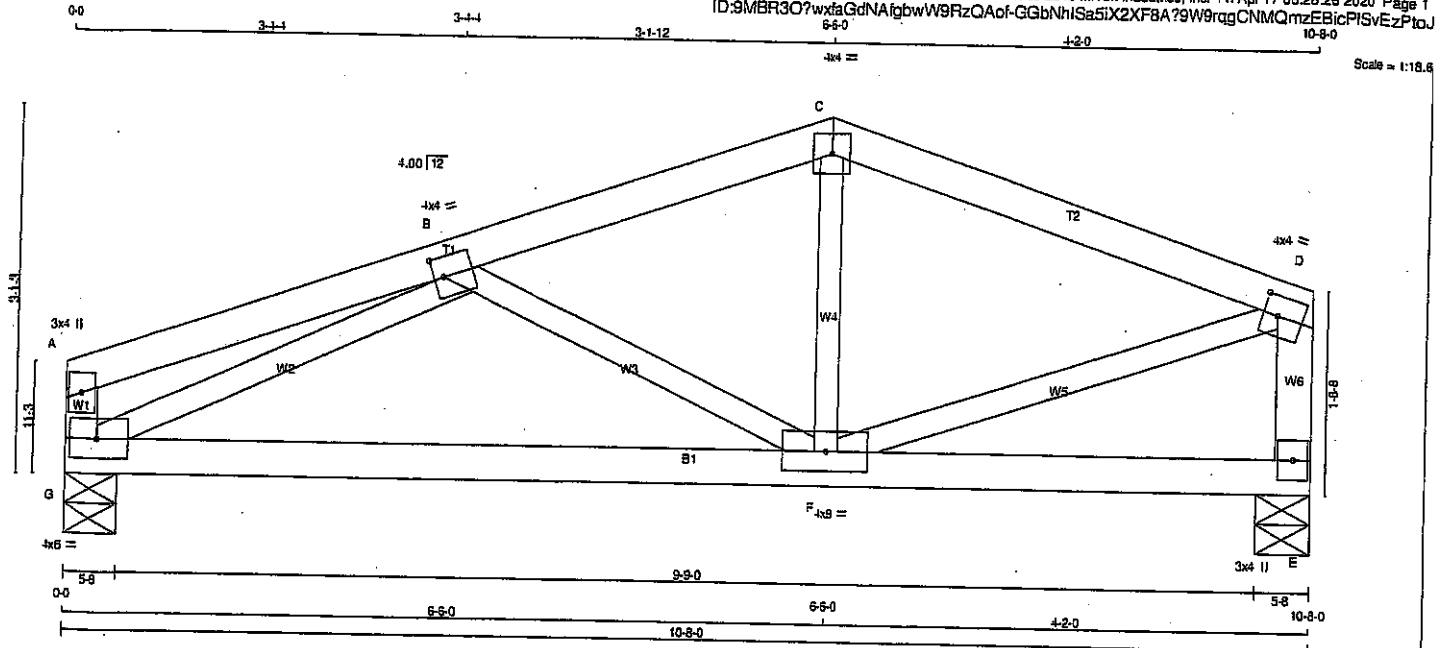

Scale = 1:18.8

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER DESCR.
A - C 2x4 DRY No.2 SPF
C - D 2x4 DRY No.2 SPF
G - A 2x4 DRY No.2 SPF
E - D 2x4 DRY No.2 SPF
G - E 2x4 DRY No.2 SPF
ALL WEBS 2x3 DRY No.2 SPF
EXCEPT
DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REQD
E	588	588	5-8	5-8
G	588	588	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
E	416	273 0	0 0	143 0	0 0
G	416	273 0	0 0	143 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH
A-B	0 / 10	-91.8	-91.8	0.14 (1)	B-F	-269 0	0.07 (1)
B-C	-586 / 0	-91.8	-91.8	0.11 (1)	F-C	0 83	0.03 (4)
C-D	-586 / 0	-91.8	-91.8	0.21 (1)	G-B	-985 / 0	0.22 (1)
G-A	-121 / 0	0.0	0.0	0.01 (1)	F-D	0 587	0.13 (1)
E-D	-565 / 0	0.0	0.0	0.06 (1)			
G-F	0 / 793	-18.5	-18.5	0.22 (4)			
F-E	0 / 0	-18.5	-18.5	0.17 (4)			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.36")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.36")
CALCULATED VERT. DEFL.(TL) = L/999 (0.06")

CSI: TC=0.21/1.00 (C-D:1), BC=0.22/1.00 (F-G:4), WB=0.22/1.00 (B-G:1), SS=0.14/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1657 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.82 (D) (INPUT = 0.90)
JSI METAL= 0.29 (B) (INPUT = 1.00)

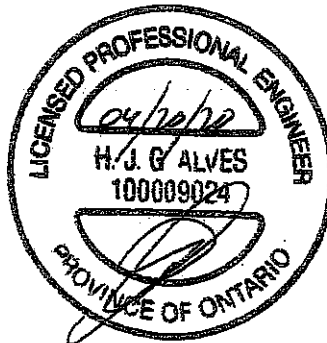

JOB NAME 421225	TRUSS NAME T137	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	---------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Tue Aug 24 17:31:28 2021 Page 1
IDuqqs_6XwriBIHcUBaEP9inzQC9m-RoAbyu86sJfxBum6JBfTeT_Hg9I_C6nxv9gvh5ykaZD

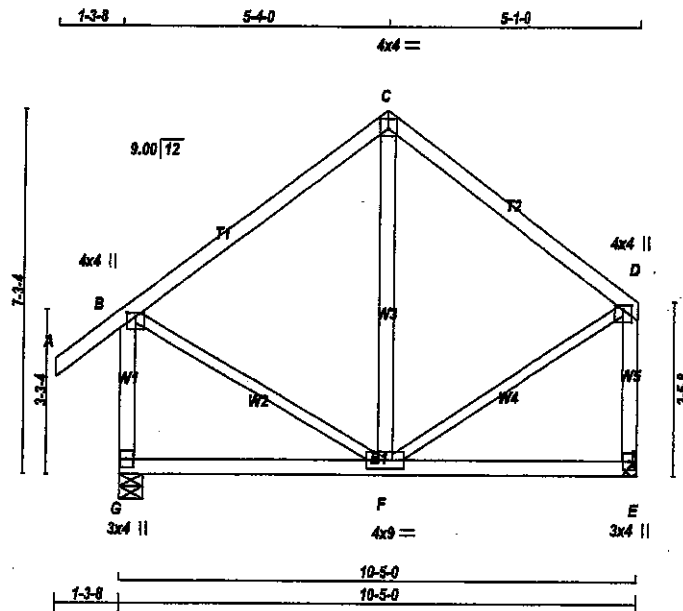

TOTAL WEIGHT = 52 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
G - B	2x4	DRY	No.2
E - D	2x4	DRY	No.2
G - E	2x4	DRY	No.2

ALL WEBS			
EXCEPT	SIZE	DRY	No.2
B - F	2x3	DRY	No.2
F - D	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTW-p	MT20	4.0	4.0	2.25	2.00
D	TMVW+p	MT20	4.0	4.0	1.00	2.00
E	BMV1+p	MT20	3.0	4.0		
F	BMVWW-t	MT20	4.0	9.0		
G	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT	REQ'D	
JT	GROSS REACTION			GROSS REACTION		BRG	BRG	
	VERT	HORZ		DOWN	HORZ	UPLIFT	IN-SX	IN-SX
G	701	0		701	0	0	5-8	5-8
E	574	0		574	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
G	493	337 / 0	0 / 0	0 / 0	0 / 0	0 / 0	158 / 0	0 / 0
E	406	267 / 0	0 / 0	0 / 0	0 / 0	0 / 0	140 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	MAX. UNBRACED LENGTH (FT)
A-B	0 / 38	-91.8	-91.8 0.12 (1)	F-C	-142 / 37	0.09 (1)	10.00
B-C	-280 / 0	-91.8	-91.8 0.33 (1)	B-F	0 / 256	0.06 (1)	6.25
C-D	-280 / 0	-91.8	-91.8 0.30 (1)	F-D	0 / 283	0.06 (1)	6.25
G-B	-463 / 0	0.0	0.0 0.12 (1)				7.81
E-D	-539 / 0	0.0	0.0 0.11 (1)				7.81
G-F	0 / 0	-18.5	-18.5 0.14 (4)				10.00
F-E	0 / 0	-18.5	-18.5 0.14 (4)				10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD = 38.0 PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.33/1.00 (B-C:1), BC=0.14/1.00 (E-F:4), WB=0.09/1.00 (C-F:1), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618	354	1667 1987 1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.52 (B) (INPUT = 0.90)
JSI METAL= 0.13 (B) (INPUT = 1.00)

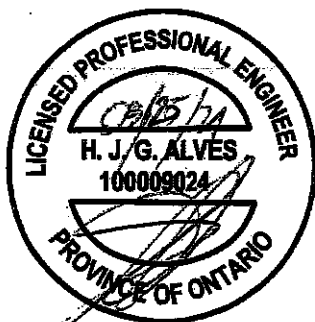


Structural component only
DWG# T-2129747

JOB NAME 421225	TRUSS NAME T137CP	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.420 S Jan 21 2021 MTek Industries, Inc. Tue Aug 24 17:31:29 2021 Page 1			

ID:uqqs_6XwnBIHcUBaEP9InzQC9m-w_kF9E9kddnoo2LthAIAhXRQZeDxZ148pQTDYyKaZC

Scale = 1:43.8

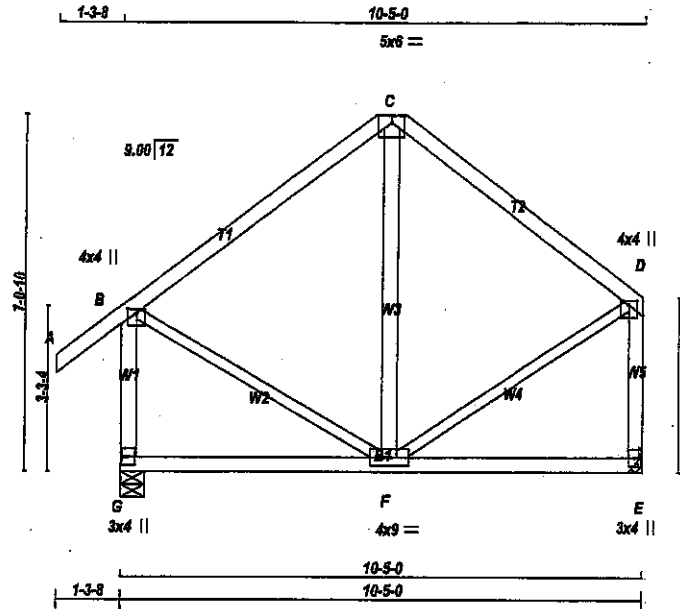

TOTAL WEIGHT = 52 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
G - B	2x4	DRY	No.2
E - D	2x4	DRY	No.2
G - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT	F - C	2x4	DRY
			No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TMTMWm	MT20	5.0	6.0	1.50	2.75
D	TMVW+p	MT20	4.0	4.0	1.00	2.00
E	BMV1+p	MT20	3.0	4.0		
F	BMVWW-t	MT20	4.0	9.0		
G	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
G	701	0	701	0	5-8	5-8
E	574	0	574	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 3-8.

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED		MAX./MIN. COMPONENT REACTIONS		WIND PERM. LIVE	DEAD	SOIL
	SNOW	LIVE	DOWN	HORZ			
G	493	337 / 0	0 / 0	0 / 0	0 / 0	158 / 0	0 / 0
E	408	267 / 0	0 / 0	0 / 0	0 / 0	140 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORZ. LOAD (LC1)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORZ. LOAD (LC1)
FR-TO		FROM	TO		FR-TO		
A-B	0 / 38	-91.8	-91.8 0.12 (1)	10.00	B-F	0 / 256	0.08 (1)
B-C	-280 / 0	-91.8	-91.8 0.33 (1)	6.25	F-D	0 / 263	0.08 (1)
C-D	-280 / 0	-91.8	-91.8 0.30 (1)	6.25	F-C	-142 / 37	0.09 (1)
G-B	-663 / 0	0.0	0.0 0.12 (1)	7.81			
E-D	-539 / 0	0.0	0.0 0.11 (1)	7.81			
G-F	0 / 0	-18.5	-18.5 0.14 (4)	10.00			
F-E	0 / 0	-18.5	-18.5 0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2016, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.35")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.35")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.02")

CSI: TC=0.39/1.00 (B-C:1), BC=0.14/1.00 (E-F:4),
WB=0.09/1.00 (C-F:1), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	MAX	MIN	MAX
	618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.52 (B) (INPUT = 0.90)
JSI METAL= 0.13 (B) (INPUT = 1.00)




Structural component only
DWG# T-2129748

JOB NAME 408187	TRUSS NAME PB1	QUANTITY 15	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	----------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 21 07:53:55 2020 Page 1
ID:Db?BaD0R9zQAt1xT57n_pqzfaiN-LcTWunrGX?ZYHihnu9_L95uZ_PEuIU9_E10gHzOZWj
7-10-11

Scale = 1:16.1

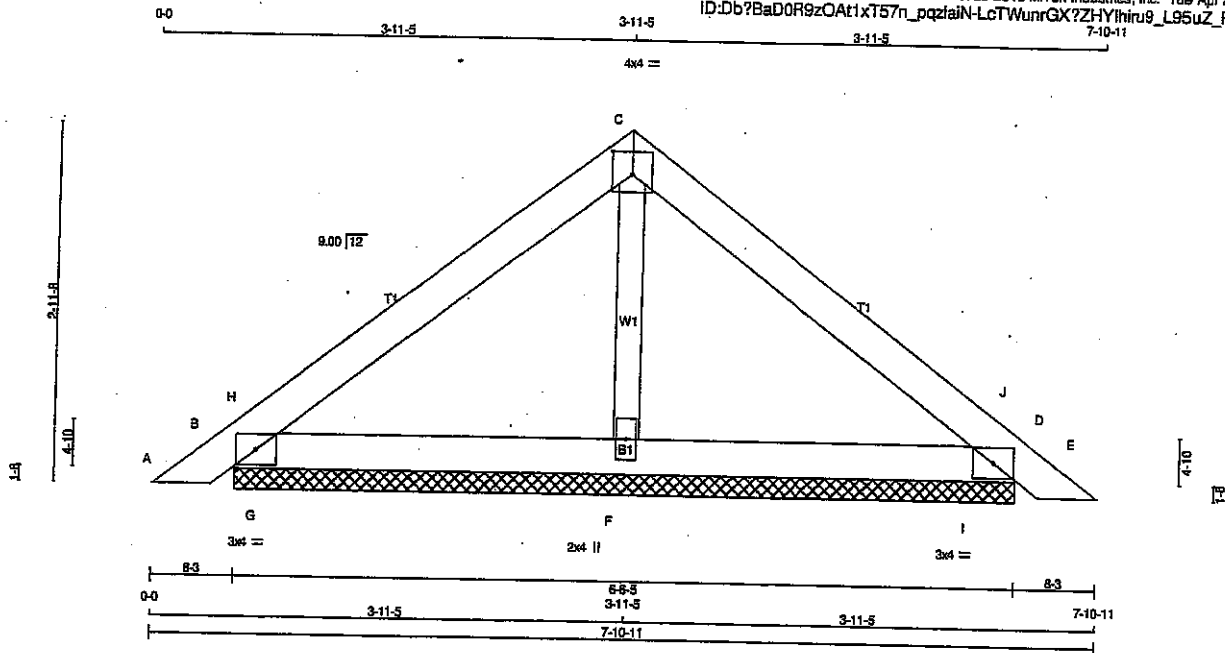

LUMBER

N. L. G. A. RULES

CHORDS SIZE

A - C 2x4 DRY No.2

C - E 2x4 DRY No.2

B - D 2x4 DRY No.2

ALL WEBS 2x3 DRY No.2

DRY: SEASONED LUMBER.

LUMBER

DESCR.

SPF

SPF

SPF

SPF

PLATES (table is in inches)

JT TYPE PLATES

B TMB1-I MT20 3.0 4.0

C TTW-p MT20 4.0 4.0 2.25 2.00

D TMB1-I MT20 3.0 4.0

F BMW1-w MT20 2.0 4.0

W

LEN

Y

X

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ
B	282	0	282	0
D	282	0	282	0
F	285	0	285	0

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	197	142/0	0/0	0/0	0/0	0/0	58/0	0/0
D	197	142/0	0/0	0/0	0/0	0/0	58/0	0/0
F	190	111/0	0/0	0/0	0/0	0/0	78/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX	CS1 (LC)	UNBRAC LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)
FR-TO											
A-B	0/15	-91.8	-91.8	0.02 (1)	10.00						
B-H	-26/0	-91.8	-91.8	0.06 (1)	6.25						
H-C	-118/0	-91.8	-91.8	0.11 (1)	6.25						
C-J	-118/0	-91.8	-91.8	0.11 (1)	6.25						
J-D	-26/0	-91.8	-91.8	0.06 (1)	6.25						
D-E	0/15	-91.8	-91.8	0.02 (1)	10.00						
B-G	0/88	-18.5	-18.5	0.12 (1)	10.00						
G-F	0/88	-18.5	-18.5	0.12 (1)	10.00						
F-I	0/88	-18.5	-18.5	0.12 (1)	10.00						
I-D	0/88	-18.5	-18.5	0.12 (1)	10.00						

TOTAL WEIGHT = 15 X 20 = 307 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS1: TC=0.11/1.00 (C-J:1), BC=0.12/1.00 (F-I:1), WS=0.02/1.00 (C-F:1), SS=0.22/1.00 (B-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1657 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.24 (B) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)



Structural component only

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408187	PB1G	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 21 07:53:56 2020 Page 1					
ID:Db?BaD0R9z0At1xT57n_pqzlaIn-q0u57sulh89SFuPbgDuMe4iOm0d9dJumZCzOZwf					
7-10-11					
Scale = 1:18.3					

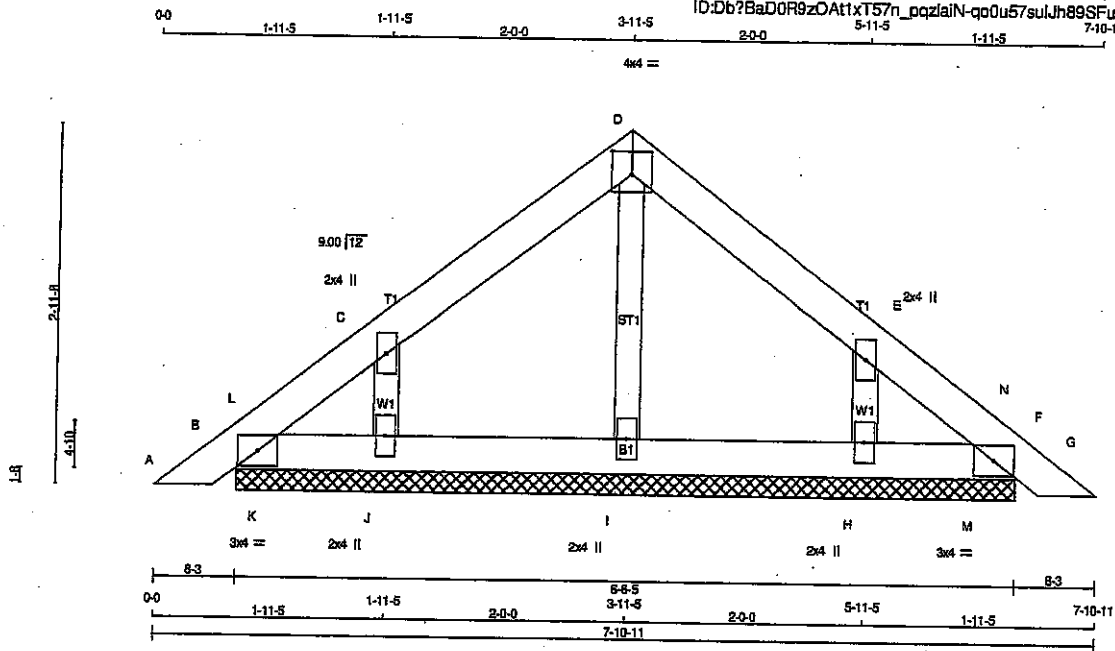

LUMBER			
N L G A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
B - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMB1-I	MT20	3.0	4.0		
C TMW+w	MT20	2.0	4.0		
D TTW-p	MT20	4.0	4.0	2.25	2.00
E TMW+w	MT20	2.0	4.0		
F TMB1-I	MT20	3.0	4.0		
H, I, J					
H BMW1+w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. UNBRACED LENGTH (FT)
FR-TO		FROM TO		FR-TO			
A-B	0 / 15	-91.8 -91.8 0.02 (1)	10.00	I-D	-119 / 0	0.02 (1)	
B-L	-64 / 0	-91.8 -91.8 0.00 (1)	6.25	J-C	-186 / 0	0.03 (1)	
L-C	-27 / 0	-91.8 -91.8 0.05 (1)	6.25	H-E	-186 / 0	0.03 (1)	
C-D	-42 / 0	-91.8 -91.8 0.05 (1)	6.25	K-L	0 / 6	0.00 (1)	
D-E	-42 / 0	-91.8 -91.8 0.05 (1)	6.25	M-N	0 / 6	0.00 (1)	
E-N	-27 / 0	-91.8 -91.8 0.05 (1)	6.25				
N-F	-64 / 0	-91.8 -91.8 0.00 (1)	6.25				
F-G	0 / 15	-91.8 -91.8 0.02 (1)	10.00				
B-K	0 / 42	-18.5 -18.5 0.01 (1)	10.00				
K-J	0 / 42	-18.5 -18.5 0.01 (4)	10.00				
J-I	0 / 25	-18.5 -18.5 0.02 (4)	10.00				
I-H	0 / 25	-18.5 -18.5 0.02 (4)	10.00				
H-M	0 / 42	-18.5 -18.5 0.01 (4)	10.00				
M-F	0 / 42	-18.5 -18.5 0.01 (1)	10.00				

TOTAL WEIGHT = 2 X 22 = 43 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
DL	=	6.0	PSF	
BOT CH.	LL	=	0.0	PSF
DL	=	7.4	PSF	
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TO=0.05/1.00 (D-E:1), BC=0.02/1.00 (H-J:4), WS=0.03/1.00 (C-J:1), SSI=0.07/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR (PL)	SECTION (PL)
	(PSI)	(PL)	(PL)
	MAX MIN	MAX MIN	MAX MIN
MT20	818 354	1687 788	1987 1658


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.13 (E) (INPUT = 0.90)
JSI METAL= 0.10 (C) (INPUT = 1.00)

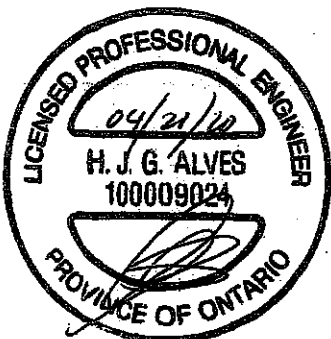

JOB NAME 408204	TRUSS NAME J1	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Flat Truss, Burlington					

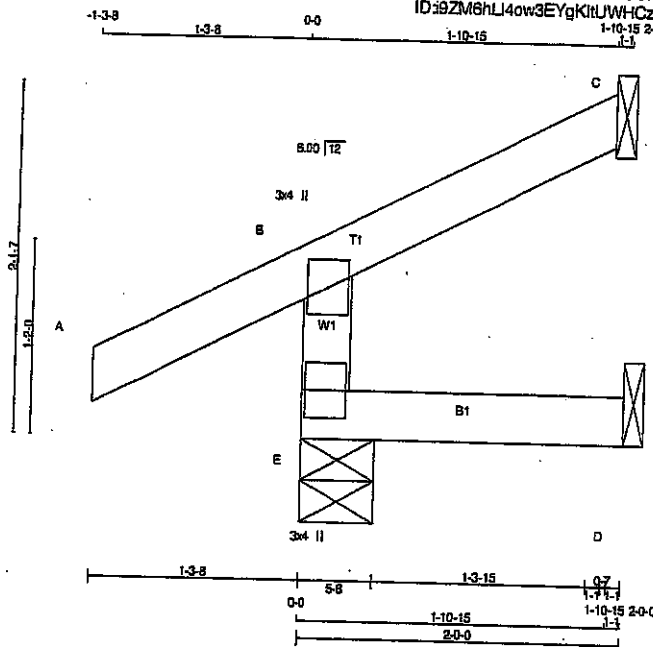

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Fri Apr 17 07:47:37 2020 Page 1
ID:9ZM6hLJ4ow3EYgKitUWHCZiH2o-T77ZhpPqF_XDvQV1K4s5OKjn8d2fhKDT10NfhzPuOa
1-10-15 2-0-0
1-10-15 2-0-0
1-3
Scale = 1:13.4

LUMBER			
N.L.G.A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX		RECORD BRG IN-SX	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX	BRG
E	254	0	254	0	0	5-8	5-8	5-8	5-8
C	66	0	66	0	0	1-8	1-8	1-8	1-8
D	16	0	16	0	0	1-8	1-8	1-8	1-8

SEE MITK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN. COMPONENT REACTIONS		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	COMBINED	SNOW	LIVE	PERM. LIVE
E	177	130.0	0.0	0.0	0.0	47.0	0.0	177	130.0	0.0	0.0
C	48	37.0	0.0	0.0	0.0	9.0	0.0	48	37.0	0.0	0.0
D	13	0.0	0.0	0.0	0.0	13.0	0.0	13	0.0	0.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		MAX. FACTORED FORCE (LBS)		FACTORED VERT. LOAD (PLF)		MAX. FACTORED VERT. LOAD (PLF)		MAX. FACTORED VERT. LOAD (PLF)		MAX. FACTORED VERT. LOAD (PLF)	
MEMB.	FR-TO	FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
E-B	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
A-B	0.728	-91.8	-91.8	0.12 (1)	10.00	0.12 (1)	10.00	0.12 (1)	10.00	0.12 (1)	10.00
B-C	-10.7	-91.8	-91.8	0.06 (1)	10.00	0.06 (1)	10.00	0.06 (1)	10.00	0.06 (1)	10.00
E-D	0.0	-18.5	-18.5	0.02 (4)	10.00	0.02 (4)	10.00	0.02 (4)	10.00	0.02 (4)	10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 7 = 22 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/998$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/998$ (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SS=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)

JSI METAL = 0.06 (B) (INPUT = 1.00)

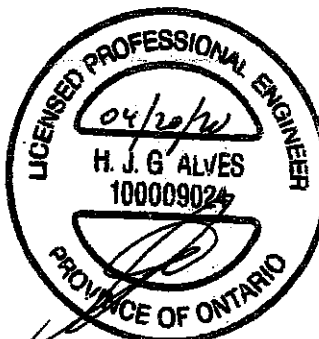


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408204	J2	3	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 07:47:38 2020 Page 1
ID:19ZM6hL14ow3EYgKItUWHCzHzo-xJhxuFq1bZ6Oq27hb1b5dbHagYzHO7aNiXlw_7zPuOz

Scale = 1:18.2

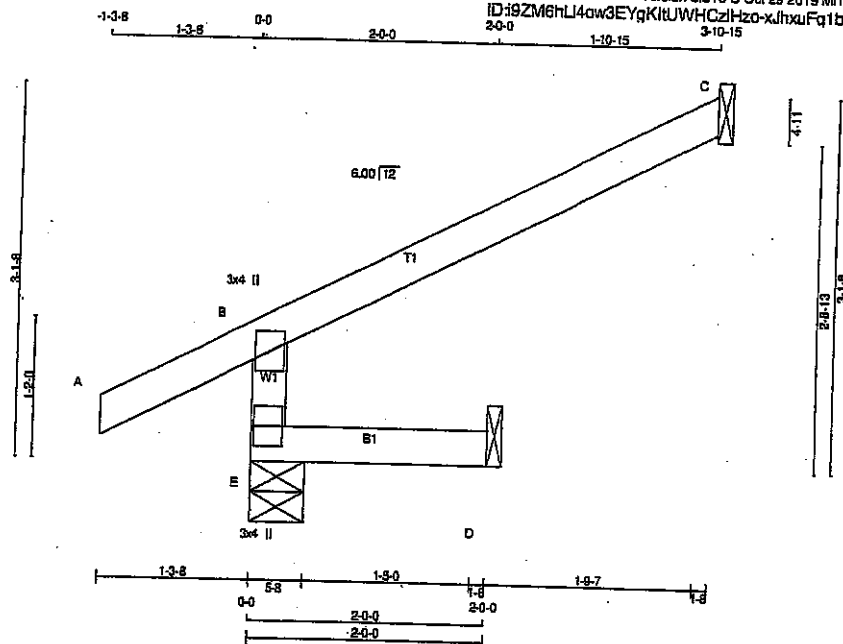

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
E BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	RECORD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	369	0	369	0	5-8	5-8
C	135	0	135	0	1-8	1-8
D	16	0	16	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LOASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	256	194 : 0	0 : 0	0 : 0	0 : 0	62 : 0	0 : 0
C	93	75 : 0	0 : 0	0 : 0	0 : 0	18 : 0	0 : 0
D	13	0 : 0	0 : 0	0 : 0	0 : 0	13 : 0	0 : 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		FACTORED		WEBS	
	MAX. FACTORED FORCE (LBS)	VERT. LOAD (LBS)	VERT. LOAD (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO						
E-B	-349 / 0	0.0	0.0	0.01 (4)	7.81	
A-B	0 / 28	-91.8	-91.8	0.13 (5)	10.00	
B-C	-20 / 0	-91.8	-91.8	0.24 (1)	6.25	
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 10 = 30 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.00")

CSI: TC=0.24/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (M:0), SS=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1997 1856

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.15 (E) (INPUT = 0.90)
JSI METAL = 0.10 (B) (INPUT = 1.00)



JOB NAME 408204	TRUSS NAME J4	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
Tamarack Roof Truss, Burlington						

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 07:47:40 2020 Page
ID:9ZM6hLJ4ow3EYgKtJWHCzIHzo-tichJwsH7AM64M94iSdZi0MCAMd_s13g9rE120zPu0

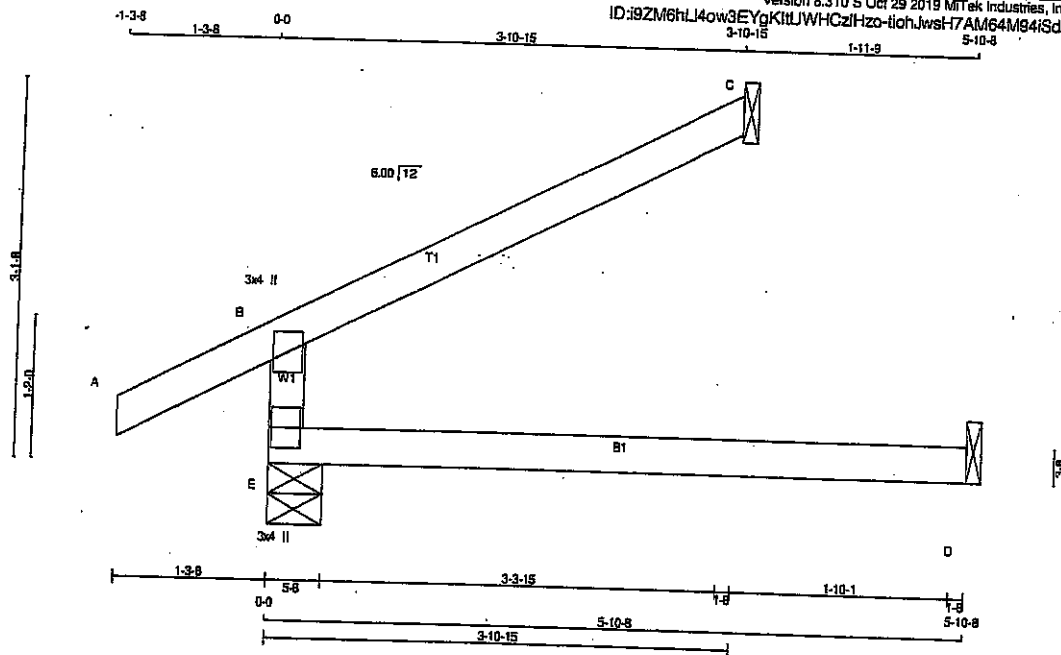

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
E	412	0	412	0
C	135	0	135	0
D	45	0	50	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
1ST/LCASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	291	194 / 0	0 / 0	0 / 0	0 / 0	97 / 0	0 / 0
C	93	75 / 0	0 / 0	0 / 0	0 / 0	18 / 0	0 / 0
D	35	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)
FR-TO		FROM TO		LENGTH FR-TO
E-B	-349 / 0	0.0 0.0 0.13 (4)	7.81	
A-B	0 / 28	-91.8 -91.8 0.12 (1)	10.00	
B-C	-20 / 0	-91.8 -91.8 0.24 (1)	6.25	
E-D	0 / 0	-18.5 -18.5 0.13 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/360 (0.20")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.00")
ALLOWABLE DEFL.(TL) = 1/360 (0.20")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.03")

CSI: TC=0.24/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.09/1.00 (n/a:0), SS=0.16/1.00 (B-C:1)

DDL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1655

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.15 (E) (INPUT = 0.90)
JSI METAL = 0.10 (B) (INPUT = 1.00)

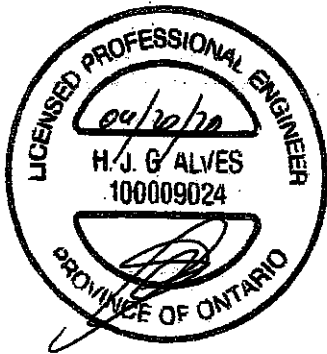


JOB NAME 408204	TRUSS NAME J5	QUANTITY 9	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 07:47:41 2020 Page
ID:9ZM6hL4ow3EYgKtUWHCziHzd-LuM4XGsvuUUYiWkGGA8oFEvIDmyDbUjOV_aaSzPuOV

Scale = 1:22

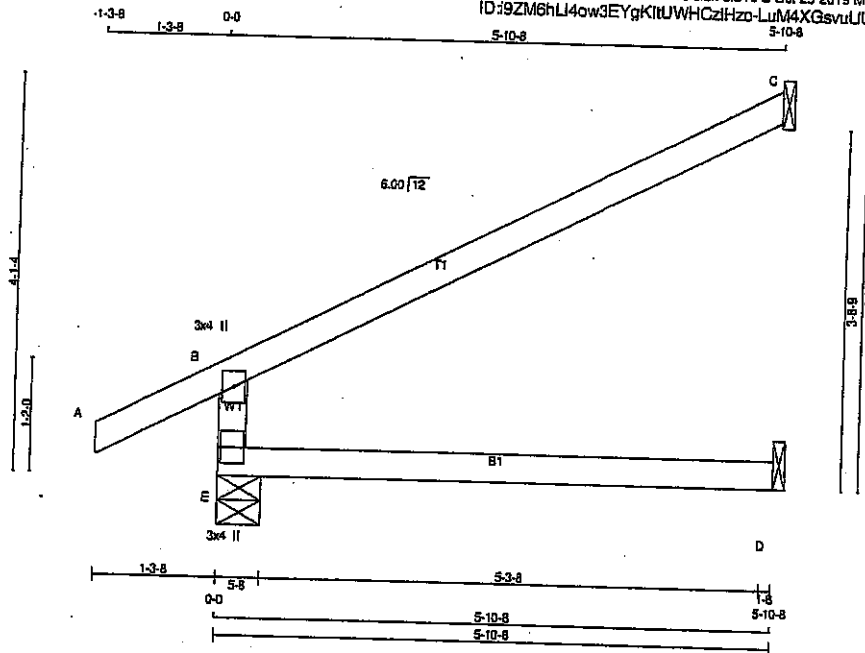

LUMBER

N. L. G. A. RULES			
CHORDS	SIZE		LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	RECRD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	525	0	525	0	5-8	5-8
C	202	0	202	0	1-8	1-8
D	45	0	50	0	1-8	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE		MAX/MIN COMPONENT REACTIONS		DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE		
E	369	257.0	0.0	0.0	111.0	0.0
C	139	113.0	0.0	0.0	28.0	0.0
D	35	0.0	0.0	0.0	36.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			FACTORED			WEBS		
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO			FR-TO			
E-B	-461.0	0.0 0.0	0.13 (4)	7.81				
A-B	0.28	-91.8 -91.8	0.12 (1)	10.00				
B-C	-30.0	-91.8 -91.8	0.54 (1)	6.25				
E-D	0.0	-18.5 -18.5	0.13 (4)	10.00				

TOTAL WEIGHT = 9 X 17 = 151 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 8.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD = 39.0 PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4),
WB=0.00/1.00 (W-A:0), SS=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1567 788	1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.19 (E) (INPUT = 0.90)
JSI METAL = 0.13 (B) (INPUT = 1.00)




JOB NAME 408187	TRUSS NAME J6	QUANTITY 7	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 08:17:40 2020 Page 1
ID:Db?BaD0R9zOA1xT57n_pqzlatN-A_ZA5PeMDD8i1_m09Uwgfcvplyyyc7gc3uGHEhZPtyF

Scale = 1:14.2

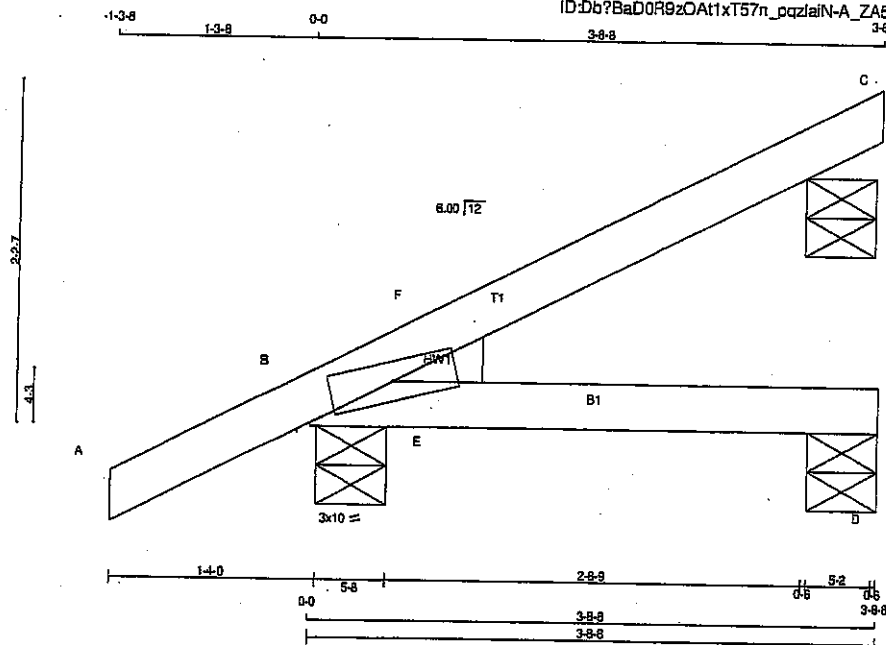

LUMBER

N. L. G. A. RULES

CHORDS SIZE

A - C 2x4 DRY

B - D 2x4 DRY

LUMBER

No.2

No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TM8H1-m	MT20	3.0	10.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG	HEEL
	VERT	HORZ	DOWN	HORZ			
C	142	0	142	0	5-8	5-8	
B	329	0	329	0	5-8	5-8	2x4 L
D	62	0	62	0	5-8	5-8	

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX. MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
C	99	76.0	0.0	0.0	0.0	23.0	0.0
B	230	164.0	0.0	0.0	0.0	66.0	0.0
D	46	19.0	0.0	0.0	0.0	27.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. FACTORED CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM	TO		FR-TO			
A-B	0 / 26	-91.8	-91.8	0.13 (5)	10.00	E-F	-123.3	0.00 (1)
B-F	-17.0	-91.8	-91.8	0.05 (4)	6.25			
F-C	0.5	-91.8	-91.8	0.15 (1)	10.00			
B-E	0 / 0	-18.5	-18.5	0.14 (1)	10.00			
E-D	0 / 0	-18.5	-18.5	0.14 (1)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 7 X 11 = 80 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.01")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.03")

CS1: TC=0.15/1.00 (C-F:1), BC=0.14/1.00 (D-E:1),
WB=0.00/1.00 (E-F:1), SSI=0.10/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667
		788	1987

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.09 (B) (INPUT = 0.90)
JSI METAL = 0.02 (B) (INPUT = 1.00)

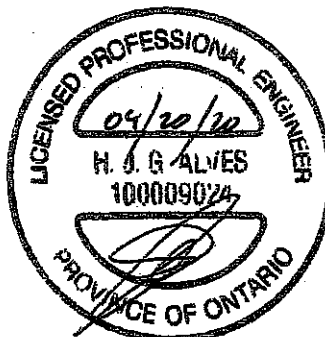


Structural component only

JOB NAME 408187	TRUSS NAME J7	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:17:41 2020 Page 1
ID:Db?BaD0R9zOAt1xT57n_pqzlaIn-sB7YJle_XGZe8KCjCRvCpS?ULKfLawmY0rm7zPtyC

Scale = 1:11.0

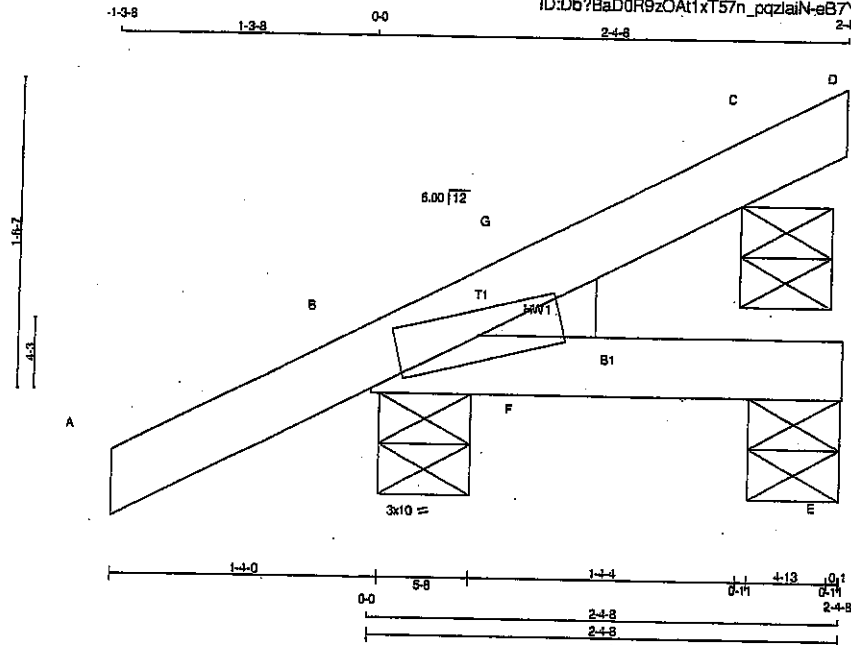

TOTAL WEIGHT = 3 X 8 = 25 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.	SPF	SPF
A - D	2x4	DRY	No.2			
B - E	2x4	DRY	No.2			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TM/SH1-m	MT20	3.0	10.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	HEEL
B	244	244	5-8	5-8	2x4 L
E	38	38	5-8	5-8	
C	112	112	5-8	5-8	

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS

JT	1ST LOASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	170	124.0	0.0	0.0	0.0	0.0	46.0	0.0
E	27	11.0	0.0	0.0	0.0	0.0	16.0	0.0
C	78	59.0	0.0	0.0	0.0	0.0	19.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)	MAX. FACTORED VERT. LOAD (LC3)	MAX. FACTORED VERT. LOAD (LC4)	MAX. FACTORED VERT. LOAD (LC5)	MAX. FACTORED VERT. LOAD (LC6)	MAX. FACTORED VERT. LOAD (LC7)	MAX. FACTORED VERT. LOAD (LC8)	MAX. FACTORED VERT. LOAD (LC9)	MAX. FACTORED VERT. LOAD (LC10)
FR-TO													
A-B	0.26		-91.8	-91.8	0.12 (5)	10.00							
B-G	-16.0		-91.8	-91.8	0.04 (1)	6.25							
G-C	0.10		-91.8	-91.8	0.05 (1)	10.00							
C-D	-7.0		-91.8	-91.8	0.01 (1)	10.00							
B-F	0.0		-18.5	-18.5	0.05 (1)	10.00							
F-E	0.0		-18.5	-18.5	0.05 (1)	10.00							

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:5), BC=0.05/1.00 (E-F:1),
WB=0.00/1.00 (F-G:1), SS=0.09/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PL)
MT20	618	354
	1667	788
	1987	1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.05 (B) (INPUT = 0.90)
JSI METAL= 0.01 (B) (INPUT = 1.00)

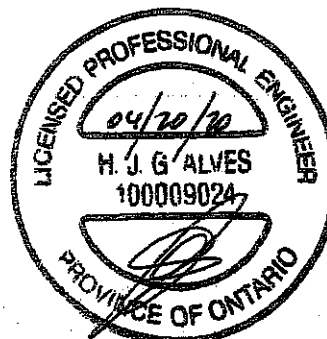


Structural component only

JOB NAME 408187	TRUSS NAME J8	QUANTITY 7	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 08:17:42 2020 Page 1
ID:Db7BaD0R9zOAt1xT57n_pqzlatN-6NhwW5fdrCQGHvPGvy8177Cld141AvXCIOIZzPty

Scale = 1/16"

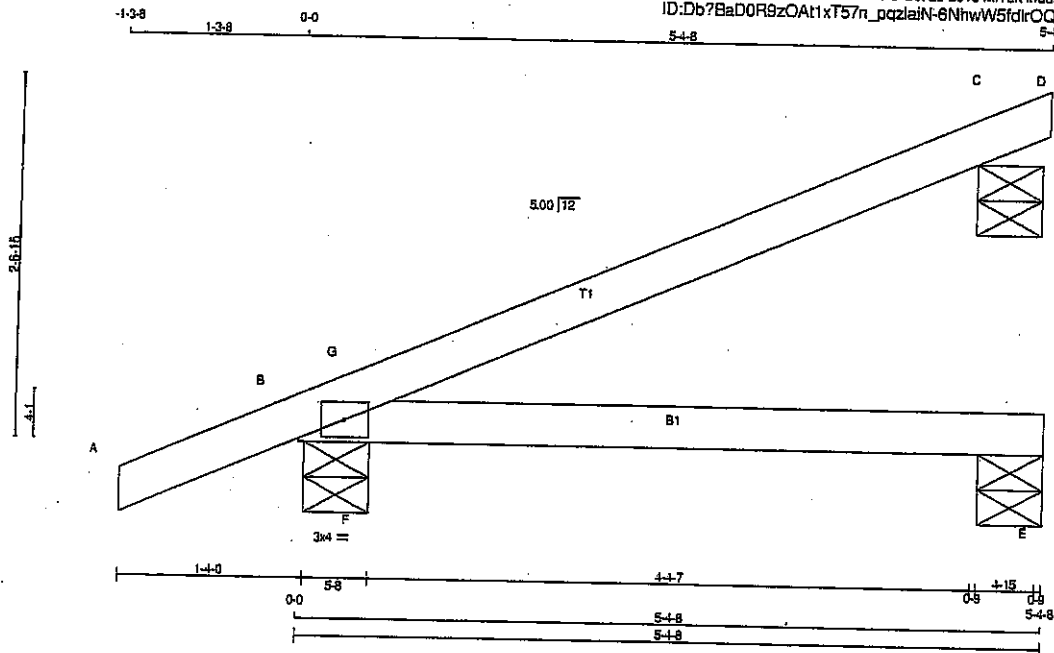

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
A - D	2x4	DRY No.2
B - E	2x4	DRY No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-1	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
B	409	0	409	0	5-8	5-8
E	76	0	76	0	5-8	5-8
C	237	0	237	0	5-8	5-8

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX. MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	287	200.0	0.0	0.0	0.0	86.0	0.0
E	57	19.0	0.0	0.0	0.0	38.0	0.0
C	184	128.0	0.0	0.0	0.0	38.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LC1 MAX. (LC1)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LC1 MAX. (LC1)	
FR-TO				FR-TO			
A-B	0 23	-91.8	-91.8 0.12 (1)	10.00	F-G	-289 23	0.00 (1)
B-G	-26 22	-91.8	-91.8 0.08 (4)	8.25			
G-C	-2 2	-91.8	-91.8 0.32 (1)	10.00			
C-D	-6 0	-91.8	-91.8 0.01 (1)	10.00			
B-F	0 0	-18.5	-18.5 0.20 (1)	10.00			
F-E	0 0	-18.5	-18.5 0.21 (1)	10.00			

TOTAL WEIGHT = 7 X 15 = 102 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.04")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/709 (0.09")

CSI: TC=0.32/1.00 (C-G:1), BC=0.21/1.00 (E-F:1),
WB=0.00/1.00 (F-G:1), SSI=0.24/1.00 (B-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1867 788
	1867 1656	

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.29 (B) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)



Structural component only

JOB NAME 408188	TRUSS NAME J30	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

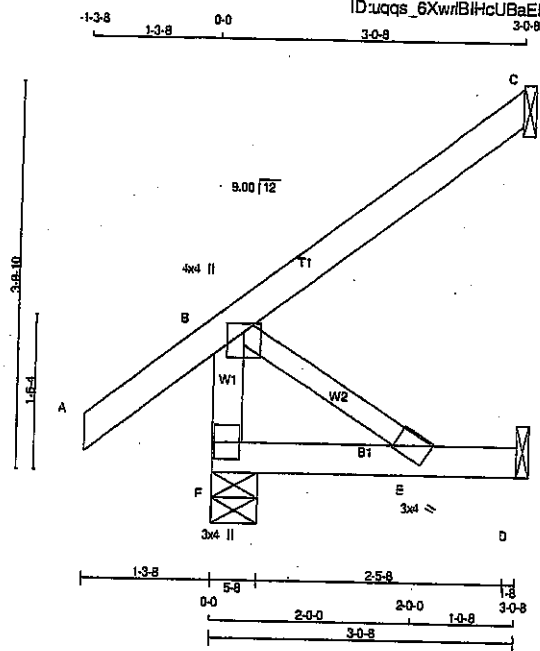

LUMBER			
N.L.G.A. RULES	CHORDS	SIZE	LUMBER
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
E	BMW+w	MT20	3.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	IN-SX
F	294	0	0	294	0	0	0	5-8	5-8
C	140	0	0	140	0	0	0	1-8	1-8
D	28	0	0	32	0	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	206	148 0	0 0	0 0	0 0	0 0	57 0	0 0
C	96	78 0	0 0	0 0	0 0	0 0	18 0	0 0
D	23	0 0	0 0	0 0	0 0	0 0	23 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		WEBS	
MEMB.	FORCE (LBS)	MAX. FACTORED FORCE (PLF)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO	MEMB. LENGTH FR-TO
F-B	-266 0	0.0 0.0 0.03 (1)	7.81 B-E
A-B	0 38	-91.8 -91.8 0.13 (5)	10.00
B-C	0 0	-91.8 -91.8 0.14 (1)	10.00
F-E	0 0	-18.5 -18.5 0.05 (4)	10.00
E-D	0 0	-18.5 -18.5 0.05 (4)	10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 4 X 13 = 52 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
CL = 8.0 PSF
BOT CH. LL = 0.0 PSF
CL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00")

CSI: TC=0.14/1.00 (B-C:1), BC=0.05/1.00 (E-F:4),
WB=0.00/1.00 (B-E:1), SS=0.09/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 518 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (B) (INPUT = 0.90)
JSI METAL = 0.05 (B) (INPUT = 1.00)

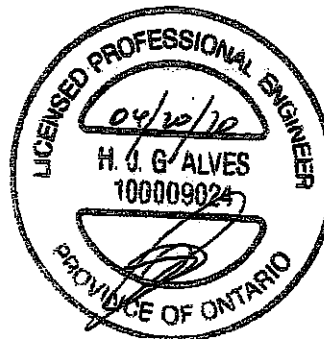

Structural component only

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408188	J31	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

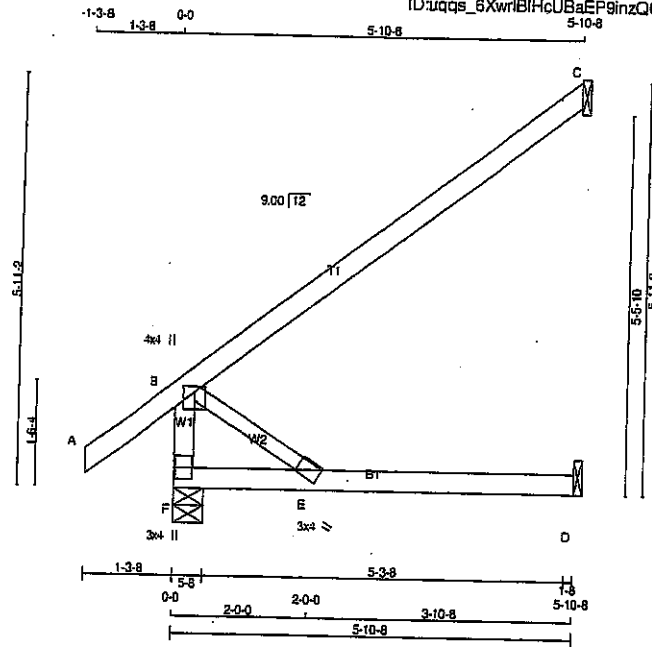

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
E	BMVW+p	MT20	3.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REORD	
JT	VERT	HORZ	GROSS REACTION	DOWN	HORZ	BRG	IN-SX	BRG	IN-SX
F	450	0	450	0	0	5-8	5-8	5-8	5-8
C	270	0	270	0	0	1-8	1-8	1-8	1-8
D	54	0	61	0	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
C	318	221 0	0 0	0 0	0 0	95 0	0 0	0 0
D	186	150 0	0 0	0 0	0 0	35 0	0 0	0 0
F	43	0 0	0 0	0 0	0 0	43 0	0 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FROM	TO	FR-TO	
F-B	-398 0	0.0	0.0 0.04 (1)	B-E	0 0
A-B	0 38	-91.8	-91.8 0.12 (1)		
B-C	0 0	-91.8	-91.8 0.54 (1)		
F-E	0 0	-18.5	-18.5 0.17 (4)		
E-D	0 0	-18.5	-18.5 0.19 (4)		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.05")

CSI: TC=0.54/1.00 (B-C:1), BC=0.19/1.00 (D-E:4),
WB=0.00/1.00 (B-E:1), SS=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.32 (B) (INPUT = 0.90)
JSI METAL = 0.08 (B) (INPUT = 1.00)

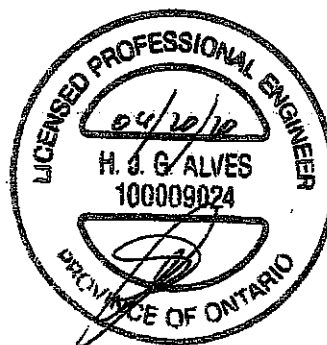

Structural component only

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408188	J32	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
TRUSS DESC.					

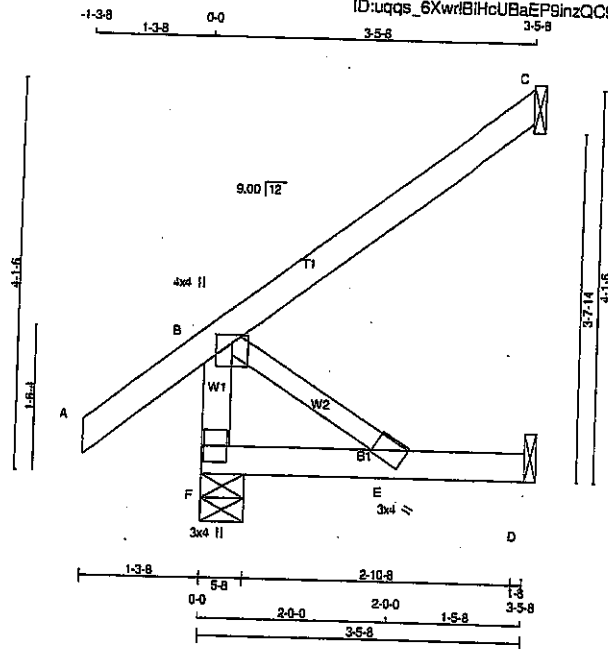

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:26:07 2020 Page
ID:uqq5_6Xw7BIHcUBaEPsInzQC9m-qXiqVmmQq?0mLu0SMTWZjWPTnK0ivQBETGabWozPtq

Scale = 1:23

LUMBER				DESIGN CRITERIA			
N. L. G. A. RULES				SPECIFIED LOADS:			
CHORDS	SIZE	LUMBER	DESCR.	TOP CH.	LL	=	25.8 PSF
F - B	2x4	DRY	No.2	DL	=	8.0 PSF	
A - C	2x4	DRY	No.2	BOT CH.	LL	=	0.0 PSF
F - D	2x4	DRY	No.2	DL	=	7.4 PSF	
ALL WEBS	2x3	DRY	No.2	TOTAL LOAD	=	39.0 PSF	
DRY: SEASONED LUMBER.				SPACING = 24.0 IN. C/C			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
E	BMW+w	MT20	3.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY
BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
F	317	0	317	0	0	5-8	5-8	5-8	5-8
C	159	0	159	0	0	1-8	1-8	1-8	1-8
D	32	0	36	0	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST CASE		MAX/MIN. COMPONENT REACTIONS		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	COMBINED	SNOW	LIVE	PERM. LIVE
F	222	159.0	0.0	0.0	0.0	63.0	0.0	222	159.0	0.0	0.0
C	109	88.0	0.0	0.0	0.0	21.0	0.0	109	88.0	0.0	0.0
D	26	0.0	0.0	0.0	0.0	26.0	0.0	26	0.0	0.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.


ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		MAX. FACTORED		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX. CS1 (LC)	UNBRACED LENGTH	MEMB.	FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO				FR-TO			
F-B	-285.0	0.0	0.0	0.03 (1)	7.81	B-E	0.0	0.00 (1)	
A-B	0.38	-91.8	-91.8	0.14 (5)	10.00				
B-C	0.0	-91.8	-91.8	0.19 (1)	10.00				
F-E	0.0	-18.5	-18.5	0.06 (4)	10.00				
E-D	0.0	-18.5	-18.5	0.06 (4)	10.00				


CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

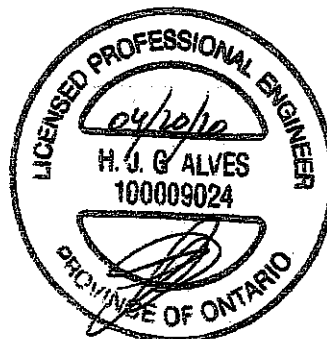

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1658
PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP = 0.23 (B) (INPUT = 0.90)
JSI METAL = 0.08 (B) (INPUT = 1.00)

Structural component only

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408188	J33	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:26:09 2020 Page 1					
ID:uqqs_6XwrlBIHcUBaEP9inzQC9m-mvqbwSoeLchUBCarTuZ1oxVle7imNKhX6a3ibhzPiq					
Scale = 1:19.1					

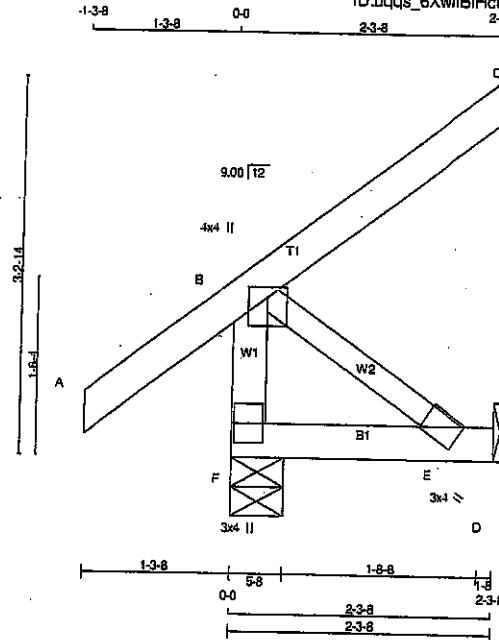

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
E	BMVW+w	MT20	3.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
F	366	0	366	0	0
D	21	0	24	0	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) D

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED SNOW LIVE PERM. LIVE WIND DEAD SOIL
F	254 192 0 0 0 0 0 0 0 0
D	17 0 0 0 0 0 0 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
F-B	-345 / 0	B-E	0 / 0
A-B	0 / 38		
B-C	-65 / 0		
F-E	0 / 0		
E-D	0 / 0		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.38/1.00 (B-C:1), BC=0.03/1.00 (E-F:4),
WB=0.00/1.00 (B-E:1), SS=0.14/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.27 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)

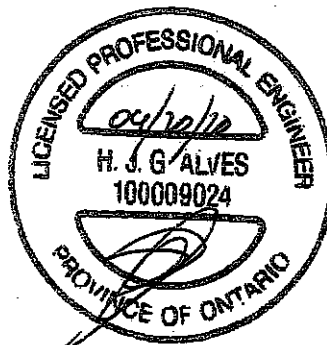

JOB NAME 408188	TRUSS NAME J34	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:26:10 2020 Page
ID:uqqs_6XwrlBIHcUBaEP9inzQC9m-F6Nz8opG6wPLCM11b4GK91_zX2U6nxgLEpF77zPtq

Scale = 1:14

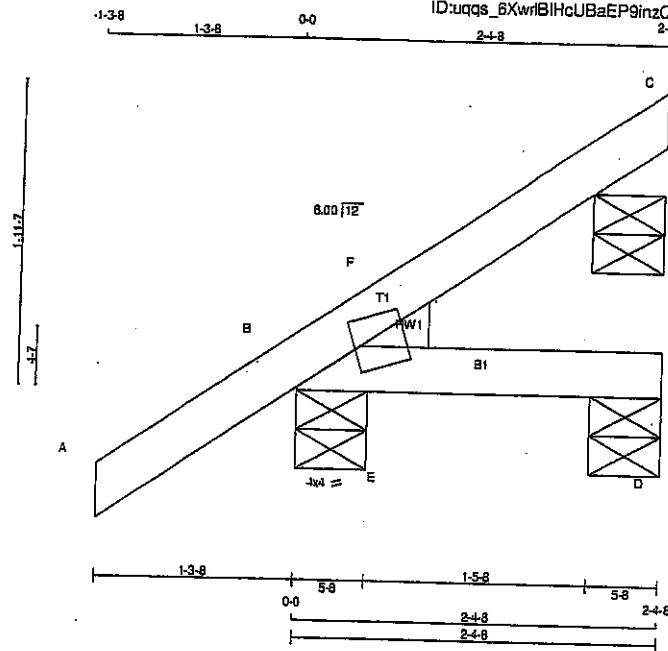

LUMBER

N. L. G. A. RULES

CHORDS SIZE

A - C 2x4 DRY No.2

B - D 2x4 DRY No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMSH1-m	MT20	4.0	4.0	2.00	0.50

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	HEEL WEDGE
	VERT	DOWN	UP/LIFT	IN-SX	
C	89	0	0	5-8	
B	257	0	0	5-8	
D	42	0	0	5-8	2x4 L

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE			
C	62	47.0	0.0	0.0	14.0	0.0
B	179	131.0	0.0	0.0	48.0	0.0
D	31	13.0	0.0	0.0	18.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 MAX. (CSI (LC))	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. (CSI (LC))
FR-TO						FR-TO			
A-B	0.34	-91.8	-91.8	0.13 (5)	10.00	E-F	-75.0	0.00 (1)	
B-F	-15.0	-91.8	-91.8	0.02 (1)	6.25				
F-C	0.5	-91.8	-91.8	0.06 (1)	10.00				
B-E	0.0	-18.5	-18.5	0.08 (1)	10.00				
E-D	0.0	-18.5	-18.5	0.06 (1)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 6 X 8 = 51 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 085-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00")

CSI: TC=0.13/1.00 (A-B-5), BC=0.06/1.00 (B-E-1), WB=0.00/1.00 (E-F-1), SSI=0.09/1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1867 788

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.16 (B) (INPUT = 0.90)
JSI METAL = 0.04 (B) (INPUT = 1.00)



Structural component only.

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408188	J35	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 08:26:11 2020 Page 1					

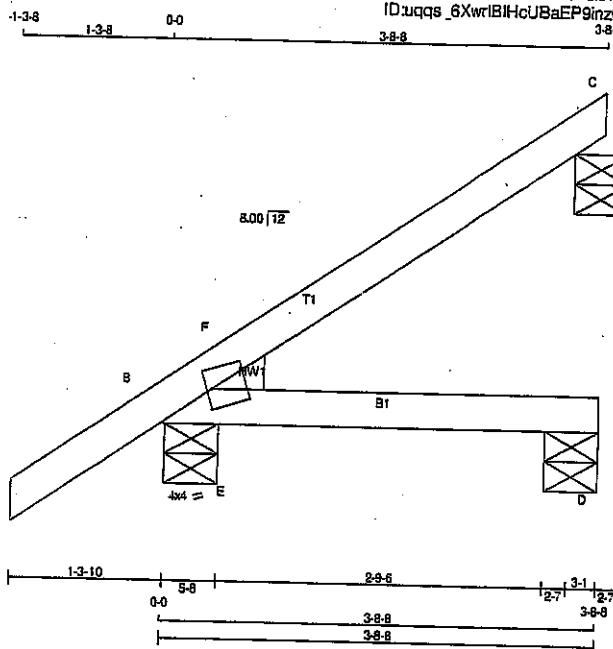

Scale = 1:18.

LUMBER				DESIGN CRITERIA	
N. L. G. A. RULES	SIZE	LUMBER	DESCR.	TOTAL WEIGHT = 4 X 12 = 47 lb	
CHORDS	2x4	DRY	No.2	SPECIFIED LOADS:	
A - C	2x4	DRY	No.2	TOP CH. LL = 25.6 PSF	
B - D	2x4	DRY	No.2	DL = 6.0 PSF	
DRY: SEASONED LUMBER.				BOT CH. LL = 0.0 PSF	
				DL = 7.4 PSF	
				TOTAL LOAD = 39.0 PSF	

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMBH1-m	MT20	4.0	4.0	2.00 0.50

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REORD BRG IN-SX	HEEL WEDGE
	VERT	HORZ	DOWN	HORZ			
C	144	0	144	0	5-8 (3-1)	5-8	
B	330	0	330	0	5-8	5-8	2x4 L
D	61	0	61	0	5-8	5-8	

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS

JT	COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
C	99	77.0	0.0	0.0	0.0	22.0	0.0
B	231	185.0	0.0	0.0	0.0	66.0	0.0
D	45	18.0	0.0	0.0	0.0	27.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		FACTORED				WEBS		MAX. FACTORED	
	FORCE (LBS)	VERT. LOAD (LBS)	PLF	LC1	MAX	MAX.	MEMB.	FORCE (LBS)	MAX	CS1 (LC)
FR-TO			FROM	TO			FR-TO			
A-B	0/34	-91.8	-91.8	0.14 (5)	10.00		E-F	-155.0	0.00 (1)	
B-F	-16.0	-91.8	-91.8	0.04 (4)	6.25					
F-C	0.3	-91.8	-91.8	0.15 (1)	10.00					
B-E	0.0	-18.5	-18.5	0.14 (1)	10.00					
E-D	0.0	-18.5	-18.5	0.14 (1)	10.00					

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CS1: TC=0.15/1.00 (C-F:1), BC=0.14/1.00 (B-E:1), WB=0.00/1.00 (E-F:1), SS=0.13/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.22 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)

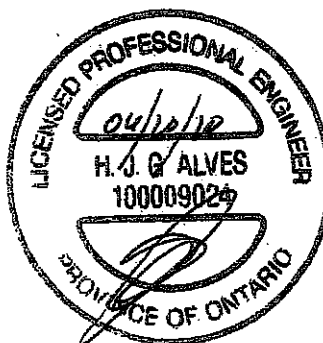

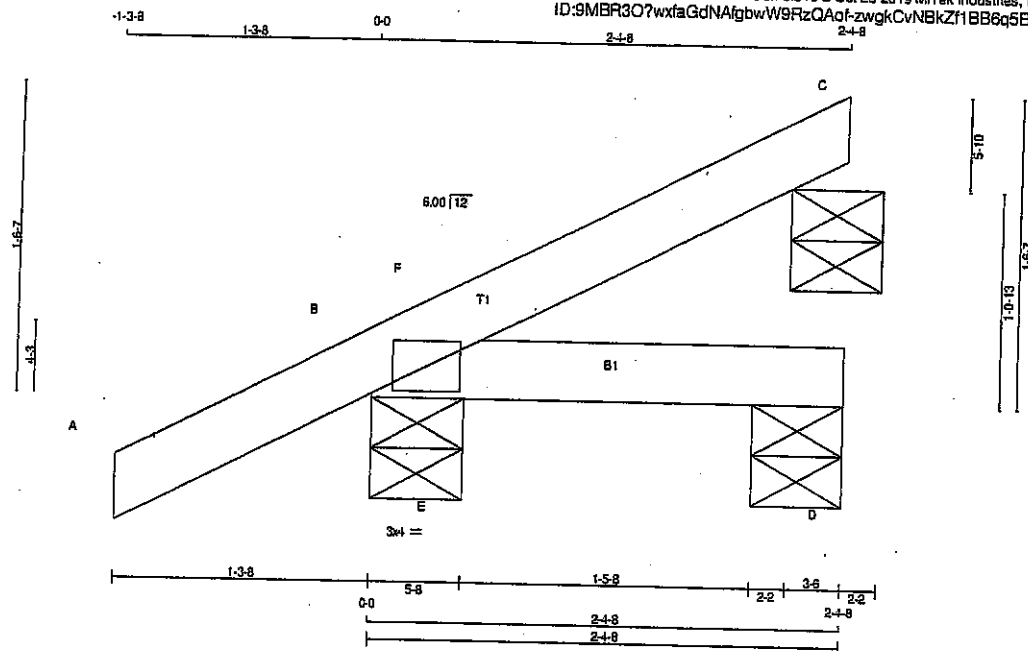

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER
A - C 2x4 DRY No.2
B - D 2x4 DRY No.2
DRY: SEASONED LUMBER.
GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-1	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0.26	-91.8	-91.8	0.12 (5)	10.00	E-F	-95.2
B-F	-9.0	-91.8	-91.8	0.02 (4)	10.00		0.00 (1)
F-C	0.2	-91.8	-91.8	0.05 (1)	10.00		
B-E	0.0	-18.5	-18.5	0.05 (1)	10.00		
E-D	0.0	-18.5	-18.5	0.05 (1)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 6 X 8 = 45 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B-5), BC=0.05/1.00 (B-E-1), WB=0.00/1.00 (E-F-1), SSI=0.08/1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.20 (B) (INPUT = 0.90)
JSI METAL = 0.04 (B) (INPUT = 1.00)

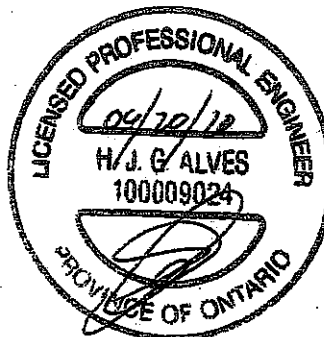

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408189	J52	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

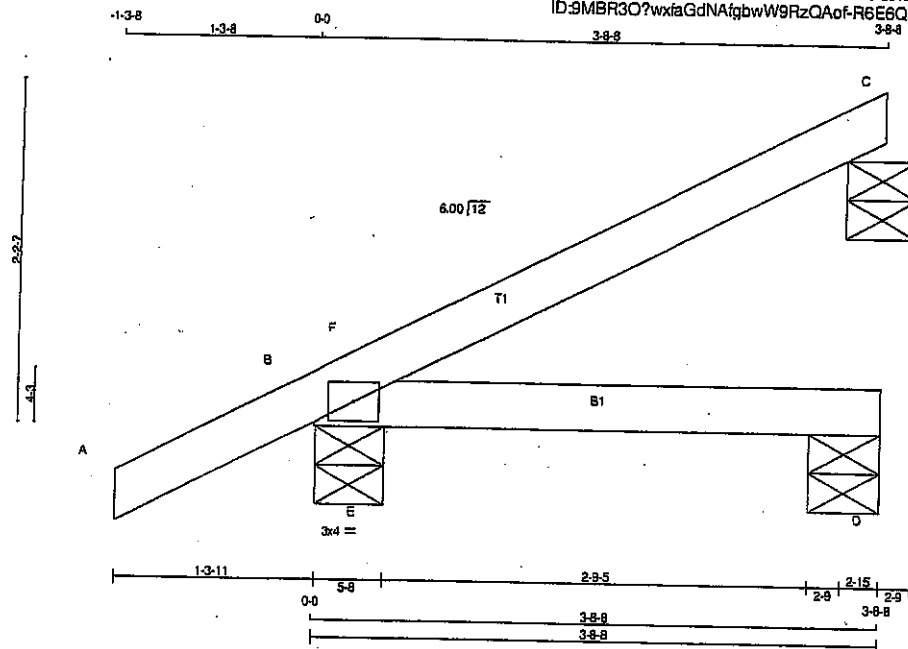

Scale = 1:14.2

LUMBER					
N. L. G. A. RULES					
CHORDS	SIZE		LUMBER		
A - C	2x4	DRY	No.2		
B - D	2x4	DRY	No.2		
DRY: SEASONED LUMBER.					

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
C	148	0	148	0	5-8 (2-15)	5-8
B	329	0	329	0	5-8	5-8
D	57	0	57	0	5-8	5-8

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS

JT	1ST LCASE		MAX. MIN. COMPONENT REACTIONS		PERM. LIVE	WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE				
C	102	80.0	0.0	0.0	0.0	0.0	23.0	0.0
B	230	164.0	0.0	0.0	0.0	0.0	66.0	0.0
D	42	15.0	0.0	0.0	0.0	0.0	27.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		WEBS		MEMB.	MAX. FACTORED	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)		MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO					FR-TO		
A-B	0.26	-91.8	-91.8	0.13 (5)	10.00	-207.5	0.00 (1)
B-F	-16.17	-91.8	-91.8	0.03 (4)	6.25		
F-C	-2.2	-91.8	-91.8	0.16 (1)	10.00		
B-E	0.0	-18.5	-18.5	0.12 (1)	10.00		
E-D	0.0	-18.5	-18.5	0.12 (1)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 4 X 11 = 43 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.01")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.02")

CSI: TC=0.16/1.00 (C-F:1), BC=0.12/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SSI=0.17/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES		PLATE GRIP(DRY) SHEAR		SECTION	
(PSI)	(PL)	(PSI)	(PL)	(PSI)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1658		

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.28 (B) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)



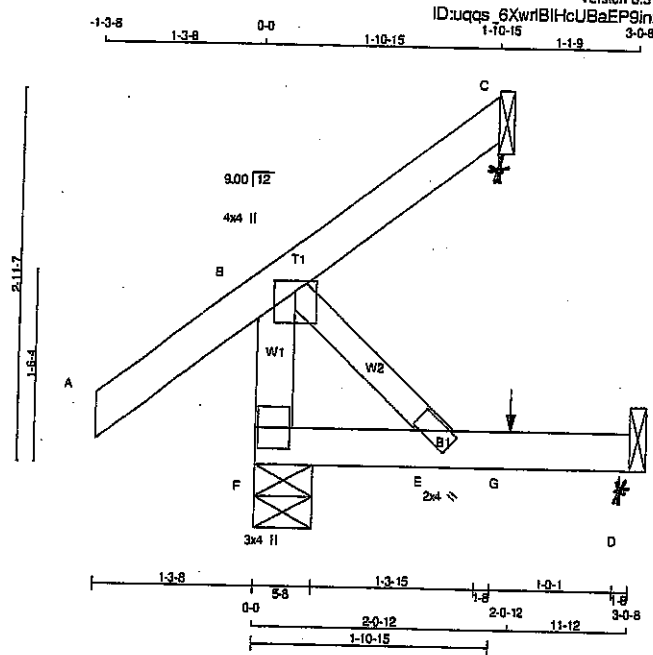

Scale = 1:17.

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00
E BMVW+w	MT20	2.0	4.0		
F BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
F	288	0	288	0	5-8	5-8		
C	42	0	42	0	1-8	1-8		
D	28	0	32	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST CASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
F	201	145.0	0.0	0.0	0.0	57.0	0.0
C	29	23.25	0.0	0.0	0.0	5.0	0.0
D	23	0.0	0.0	0.0	0.0	23.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CS1 (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO			FR-TO		
F-B	-280.0	0.0 0.0	0.03 (1)	7.81	B-E	0 0	0.00 (1)
A-B	0.38	-91.8 -91.8	0.14 (5)	10.00			
B-C	-27.0	-91.8 -91.8	0.13 (5)	6.25			
F-E	0.0	-18.5 -18.5	0.05 (4)	10.00			
E-G	0.0	-18.5 -18.5	0.05 (4)	10.00			
G-D	0.0	-18.5 -18.5	0.05 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	2-0-12	-0	-0	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 2 X 11 = 22 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.18")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.18")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CS1: TC=0.14/1.00 (A-B:5), BC=0.05/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.09/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


ISI GRIP = 0.21 (B) (INPUT = 0.90)
ISI METAL = 0.05 (B) (INPUT = 1.00)

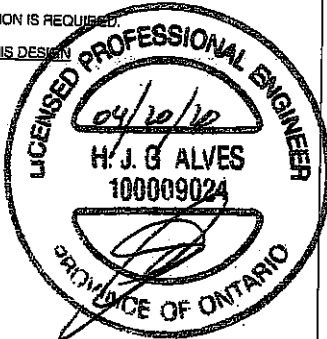

JOB NAME 408188	TRUSS NAME C31	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Fri Apr 17 08:26:03 2020 Page 1
ID:uqqs_6XwriBIHcUBaEP9inzQC9m-yISKgPitmmWKtHjh7dSdYgFomifUzzCikfcON1zPbgY
1-10-15 2-0-0

Scale = 1:17.6

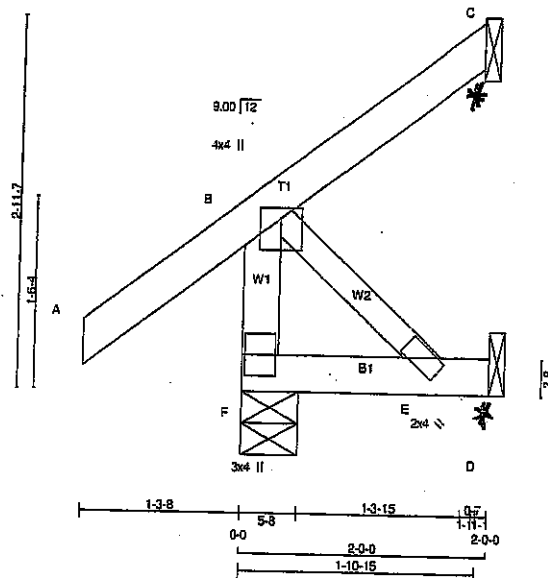

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS	2x4	DRY	No.2
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
E	BMV+w	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
F	278	0	278	0	5-8
C	42	0	42	0	-35
D	19	0	21	0	0

* SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS		1ST LCASE	MAX/MIN COMPONENT REACTIONS	PERM.LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	194	145.0	0.0	0.0	0.0	49.0	0.0
C	29	23.25	0.0	0.0	0.0	5.0	0.0
D	15	0.0	0.0	0.0	0.0	15.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)	MAX. FACTORED VERT. LOAD (LC3)	MAX. FACTORED VERT. LOAD (LC4)	MAX. FACTORED VERT. LOAD (LC5)	MAX. FACTORED VERT. LOAD (LC6)	MAX. FACTORED VERT. LOAD (LC7)	MAX. FACTORED VERT. LOAD (LC8)	MAX. FACTORED VERT. LOAD (LC9)	MAX. FACTORED VERT. LOAD (LC10)
MEMB.	FR-TO	FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)	MAX. FACTORED VERT. LOAD (LC3)	MAX. FACTORED VERT. LOAD (LC4)	MAX. FACTORED VERT. LOAD (LC5)	MAX. FACTORED VERT. LOAD (LC6)	MAX. FACTORED VERT. LOAD (LC7)	MAX. FACTORED VERT. LOAD (LC8)	MAX. FACTORED VERT. LOAD (LC9)	MAX. FACTORED VERT. LOAD (LC10)
F-B	0.0	-280.0	0.0	0.0	0.03 (1)	7.81	0.0	0.00 (1)					
A-B	0.38	0.0	-91.8	-91.8	0.12 (1)	10.00							
B-C	-27.0	0.0	-91.8	-91.8	0.12 (1)	6.25							
F-E	0.0	0.0	-18.5	-18.5	0.02 (4)	10.00							
E-D	0.0	0.0	-18.5	-18.5	0.02 (4)	10.00							

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 10 = 29 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
DL	= 6.0	PSF	
BOT CH.	LL	= 0.0	PSF
DL	= 7.4	PSF	
TOTAL LOAD	= 39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (E-F:4), WB=0.00/1.00 (B-E:1), SS=0.08/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLJ)	(PLJ)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (B) (INPUT = 0.90)
JSI METAL = 0.05 (B) (INPUT = 1.00)

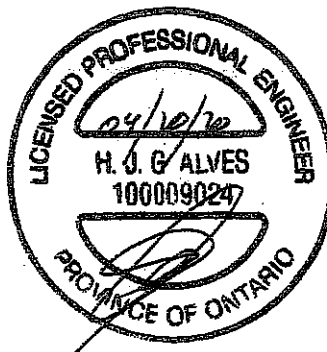

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408188	C32	1	1	GREEN PARK HOMES	
Tamarack Road Truss, Burlington				TRUSS DESC.	

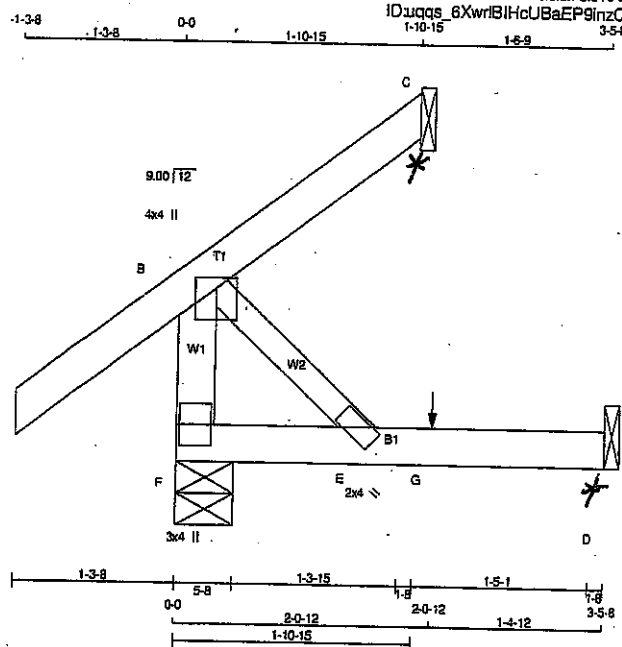

LUMBER	N.L.G.A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
E	BMW+w	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
F	292	0	292	0	5-8	5-8
C	42	0	42	0	1-8	1-8
D	32	0	32	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST CASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
F	205	145.0	0.0	0.0	0.0	60.0	0.0
C	29	23.25	0.0	0.0	0.0	5.0	0.0
D	26	0.0	0.0	0.0	0.0	26.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		FACTORED		MAX. FACTORED	MEMB.	WEBS		MAX. FACTORED
	MAX. FORCE (LBS)	VERT. LOAD (LBS)	PLF (LBS)	CSI (LC)			MAX. FORCE (LBS)	MAX. CSI (LC)	
FR-TO						FR-TO			
F-B	-260.0	0.0	0.0	0.03 (1)	7.81	B-E	0.0	0.00 (1)	
A-B	0.38	-91.8	-91.8	0.14 (5)	10.00				
B-C	-27.0	-91.8	-91.8	0.13 (5)	6.25				
F-E	0.0	-18.5	-18.5	0.06 (4)	10.00				
E-G	0.0	-18.5	-18.5	0.06 (4)	10.00				
G-D	0.0	-18.5	-18.5	0.06 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	2-0-12	1	1		FRONT	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 11 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.01")

CSI: TC=0.14/1.00 (A-B:5), BC=0.08/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.09/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES


PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JT GRIP= 0.21 (B) (INPUT = 0.80)
JTS METAL= 0.05 (B) (INPUT = 1.00)

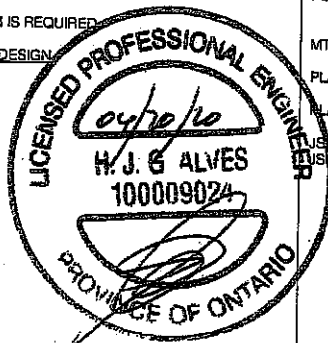

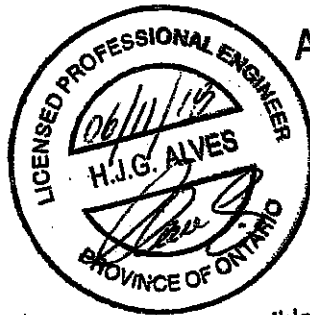

Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

F-1900218

Feb 09, 2018


TN 15-001
Piggyback Bracing

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

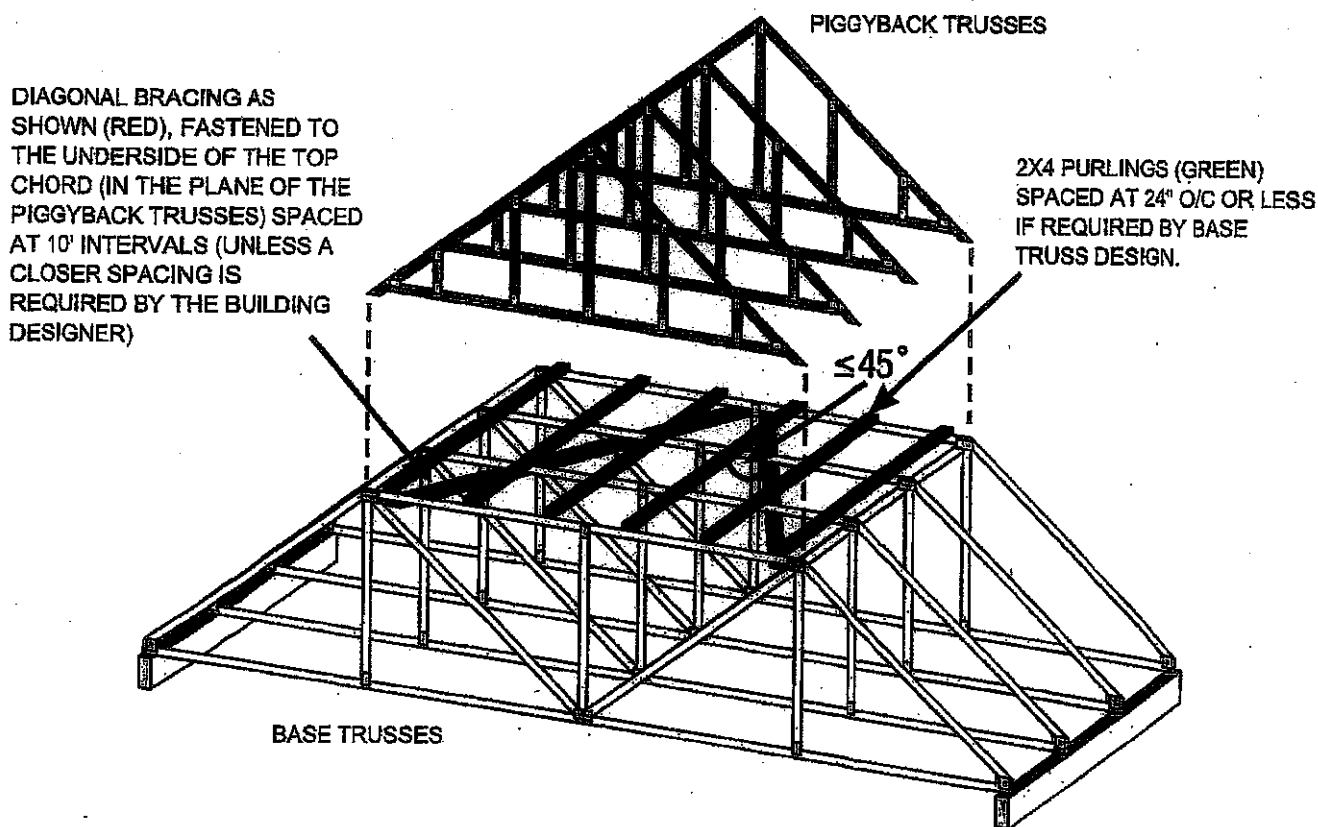

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

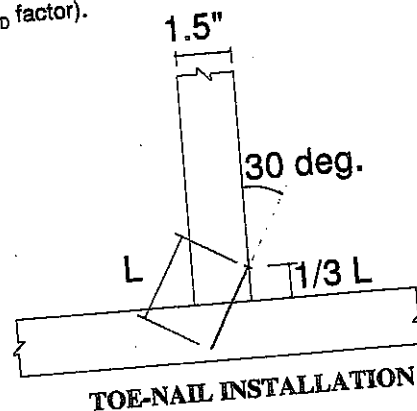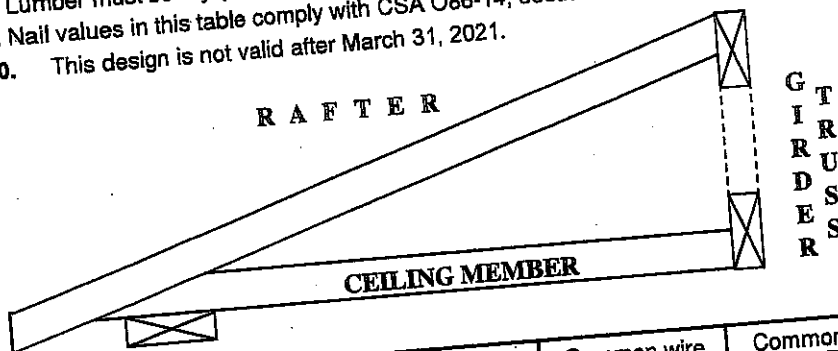

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek

MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019

BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind** or **earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

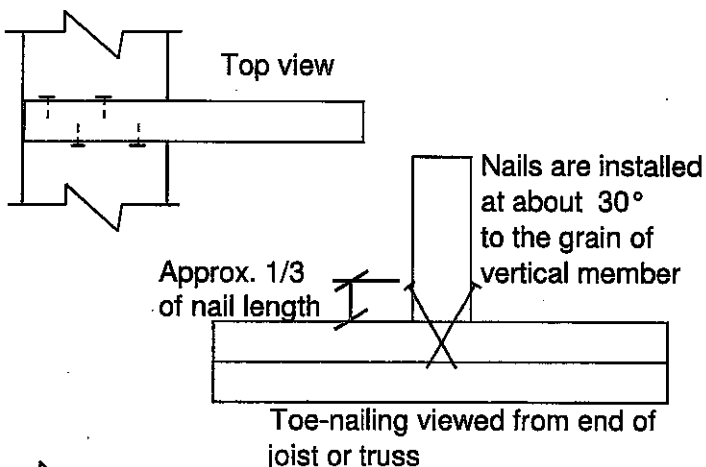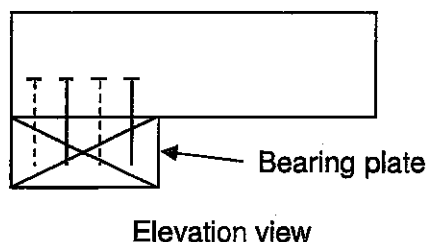

Toe-nailing on 2x4 Bearing Plate

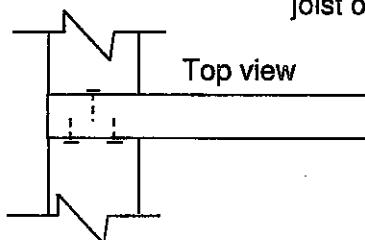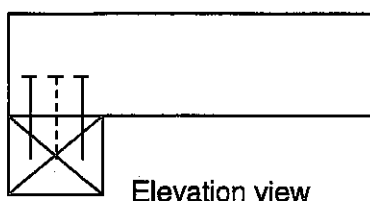

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019

LUL/LUS/LJS/HUS/HHUS/HGUS

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.

Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on p. 126.




Double-Shear
Nailing
Top View




Double-Shear
Nailing
Side View;
Do not
bend tab




Dome Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,580

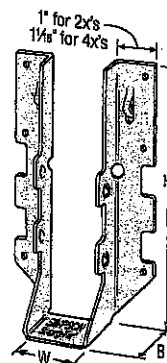


LUS28

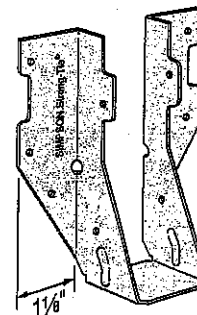


LU26L

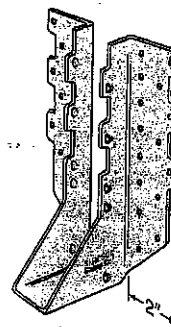


HUS210
(HUS26, HUS28,
and HHUS similar)

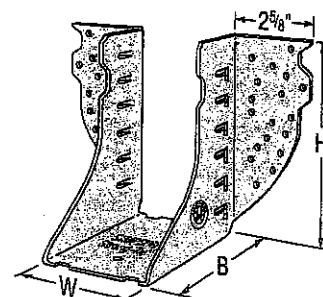

HGUS28-2

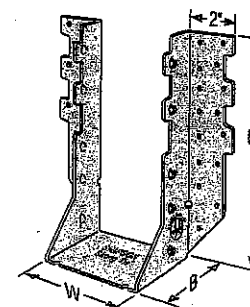


HHUS210-2



LJS26DS

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

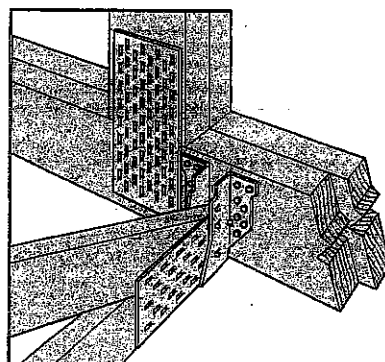

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options information on pp. 125–127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HHUS Seat Width	Joist	Down Resistance	Uplift
$W < 2"$	Bevel or square cut	0.62 of table value	0.46 of table value
$2" < W < 6"$	Bevel cut	0.67 of table value	0.41 of table value
$2" < W < 6"$	Square cut	0.46 of table value	0.41 of table value
$W > 6"$	Bevel cut	0.75 of table value	0.41 of table value

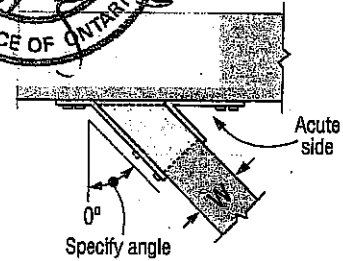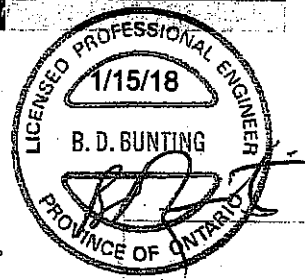

Top View HHUS Hanger Skewed Right
(joist must be bevel cut)
All joist nails installed on the outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _e ³	Header	Joist	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)
								lb.	lb.	lb.	lb.
kN	kN	kN	kN								
Single 2x Sizes											
LUS24	18	1⅞	3⅝	1⅝	2¼	(4) 10d	(2) 10d	710 3.16	1625 7.23	645 2.87	1155 5.14
LU24L	22	1⅞	3	1⅝	2⅞	(4) 10d	(2) 10d x 1½"	360 1.60	1020 4.54	320 1.42	725 3.22
LU26L	22	1⅞	5	1⅝	4⅝	(6) 10d	(4) 10d x 1½"	720 3.20	1605 7.14	645 2.87	1140 5.07
LUS26	18	1⅞	4¾	1¾	3¾	(4) 10d	(4) 10d	1420 6.32	2170 9.65	1290 5.74	1630 7.25
HUS26	16	1⅞	5⅝	3	3⅞	(14) 16d	(6) 16d	2705 11.30	4940 21.97	2065 9.20	3875 17.24
LJS26DS	18	1⅞	5	3½	4⅝	(16) 16d	(6) 16d	2055 9.14	4265 18.97	1460 6.49	4115 18.31
HGUS26	12	1⅞	5⅝	5	4⅝	(20) 16d	(8) 16d	2685 11.96	6625 29.51	2685 11.96	5700 25.35
LU28L	20	1⅞	6¾	1⅝	5⅝	(8) 10d	(6) 10d x 1½"	1140 5.07	2185 9.72	1020 4.54	1550 6.89
LUS28	18	1⅞	6⅝	1¾	3¾	(6) 10d	(4) 10d	1420 6.32	2520 11.21	1290 5.74	1790 7.96
HUS28	16	1⅞	7⅞	3	6⅞	(22) 16d	(8) 16d	3605 16.04	5365 23.86	2675 11.90	4345 19.33
HGUS28	12	1⅞	7⅞	5	6⅞	(36) 16d	(12) 16d	3310 14.74	7675 34.19	3310 14.74	6900 30.73
LU210L	20	1⅞	8	1⅝	7⅝	(10) 10d	(6) 10d x 1½"	1140 5.07	2495 11.10	1020 4.54	1770 7.87
LUS210	18	1⅞	7⅞	1¾	3¾	(8) 10d	(4) 10d	1420 6.32	2785 12.39	1290 5.74	2210 9.83


1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_g is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers

These products are available with additional corrosion protection. For more information, see p. 24.


These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _e ³	Header	Joist	D, Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb.	(K _D = 1.00) lb.	(K _D = 1.15) lb.	(K _D = 1.00) lb.
Double 2x Sizes											
LUS24-2	18	3 1/8	3 1/8	2	1 1/2	(4) 16d	(2) 16d	835 3.71	2020 8.99	590 2.62	1435 6.38
LUS26-2	18	3 1/8	4 7/8	2	4	(4) 16d	(4) 16d	1720 7.65	2595 11.54	1545 6.87	1920 8.54
HHUS26-2	14	3 1/8	5 3/8	3	3 15/16	(14) 16d	(6) 16d	2850 12.68	7335 32.63	2065 9.20	5205 23.15
HGUS26-2	12	3 1/8	5 3/8	4	4 1/8	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
LUS28-2	18	3 1/8	7	2	4	(6) 16d	(4) 16d	1720 7.65	3325 14.79	1545 6.87	2575 11.45
HHUS28-2	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3765 16.75	8940 39.77	2675 11.90	6345 28.22
HGUS28-2	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
LUS210-2	18	3 1/8	9	2	6	(8) 16d	(6) 16d	2580 11.48	4500 20.02	2320 10.32	3195 14.21
HHUS210-2	14	3 1/8	9 3/8	3	8	(30) 16d	(10) 16d	4670 20.77	9660 42.97	4235 18.84	7000 31.14
HGUS210-2	12	3 1/8	9 3/8	4	8 1/8	(46) 16d	(16) 16d	6840 30.43	14015 62.34	4855 21.60	10270 45.69
Triple 2x Sizes											
HGUS26-3	12	4 1/8	5 1/2	4	4 1/8	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
HGUS28-3	12	4 1/8	7 1/4	4	6 3/8	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
HHUS210-3	14	4 1/8	9	3	7 15/16	(30) 16d	(10) 16d	4670 20.77	9660 42.97	4235 18.84	7000 30.54
HGUS210-3	12	4 1/8	9 1/4	4	8 3/8	(46) 16d	(16) 16d	6840 30.43	14645 65.14	4855 21.60	10400 46.26
Quadruple 2x Sizes											
HGUS26-4	12	6 3/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
HGUS28-4	12	6 3/8	7 3/8	4	6 1/8	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
HHUS210-4	14	6 1/8	8 3/8	3	7 15/16	(30) 16d	(10) 16d	4670 20.77	10155 45.17	4235 18.84	7210 32.07
HGUS210-4	12	6 3/8	9 3/8	4	8 3/8	(46) 16d	(16) 16d	6840 30.43	14645 65.14	4855 21.60	10400 46.26
HGUS212-4	12	6 3/8	10 3/8	4	10 1/8	(56) 16d	(20) 16d	7640 33.98	14995 66.70	5425 24.13	10645 47.35
HGUS214-4	12	6 3/8	12 3/8	4	11 1/8	(66) 16d	(22) 16d	10130 45.06	16400 72.95	7195 32.00	11645 51.80
4x Sizes											
LUS46	18	3 1/8	4 3/8	2	3 3/8	(4) 16d	(4) 16d	1720 7.65	2595 11.54	1545 6.87	1920 8.54
HHUS46	14	3 1/8	5 1/4	3	3 15/16	(14) 16d	(6) 16d	2850 11.30	7335 32.63	2065 9.20	5205 23.15
HGUS46	12	3 1/8	5 1/4	4	4 1/8	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
LUS48	18	3 1/8	6 3/8	2	3 3/8	(6) 16d	(4) 16d	1720 7.65	3325 14.79	1545 6.87	2575 11.45
HHUS48	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3765 16.75	8940 39.77	2675 11.90	6345 28.22
HGUS48	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
LUS410	18	3 1/8	8 3/8	2	5 1/8	(8) 16d	(6) 16d	2580 11.48	4500 20.02	2320 10.32	3195 14.21
HGUS410	12	3 1/8	9	4	8 1/8	(46) 16d	(16) 16d	6840 30.43	14015 62.34	4855 21.60	10270 45.69
HGUS412	12	3 1/8	10 3/8	4	10 1/8	(56) 16d	(20) 16d	7640 33.98	14995 66.70	5425 24.13	10645 47.35
HGUS414	12	3 1/8	12 3/8	4	11 1/8	(66) 16d	(22) 16d	10130 45.06	16400 72.95	7195 32.00	11645 51.80




Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/4" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

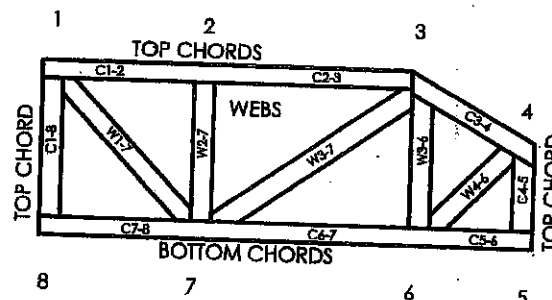

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007-MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MIL-7473C rev. 10-'08



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed; unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.