



GENERAL NOTES (PART 9 - RESIDENTIAL)

PERMIT NO. **RM#-2022-00102**

All construction must comply with the Ontario Building Code (OBC) 2012 as amended, including but not limited to the following. As a minimum, the following requirements **shall** be incorporated in the final construction:

1. All footings shall rest on natural undisturbed soil or compacted granular fill with a minimum bearing capacity of 75 KPa (1570 psf) unless known capacity is less and provided for in the foundation design.
2. Step footings shall have a maximum rise of 600 mm (23 5/8") for firm soils, 400 mm (15 3/4") for sand or gravel and a minimum horizontal run of 600 mm (23 5/8").
3. Concrete for exterior steps, garage and carport floors and all exterior flat work shall have a minimum compressive strength of 32 MPa (4650 psi) at 28 days, with air entrainment of 5 to 8%. Concrete floors with no damp proofing shall have a minimum compressive strength of 25 MPa (3000 psi). All other concrete to be 15MPa (2200 psi).
4. Foundations and the soil beneath them shall be protected against freezing during winter construction. Where foundation walls require permanent lateral support, the wall shall be braced or laterally supported before backfilling.
5. When the unsupported height of a foundation wall exceeds 3.0 m (9'-10"), the wall shall be designed by an engineer in accordance with OBC Part 4.
6. Exterior concrete stairs with more than 2 steps shall be supported on unit masonry, concrete walls or piers not less than 150x150 (6"x6") with footings at 1.2 m (4') below grade.
7. Where the top of a foundation wall is reduced in thickness to permit the installation of masonry exterior facing, the reduced section shall be not less than 90 mm (3 1/2") thick and tied to the facing material with metal ties conforming to Sentence 9.20.9.4. (3), spaced not more than 200 mm (7 7/8") o.c. vertically and 900 mm (2'-11") o.c. horizontally. The space between the wall and masonry veneer shall be filled with mortar.
8. Provide continuous lateral support to top flange of all steel beams. Steel beams shall have minimum 90 mm (3 1/2") bearing length. Connections to other steel beams shall have a minimum of 2-M20 (3/4" dia.) A325 steel bolts or a full welded connection (with full shear capacity of beam). Steel beams supported on wood shall be designed by an Engineer.
9. Provide solid blocking support under all point loads and continue down to the foundation. Built-up columns shall comply with OBC 9.23.10.7. For engineered systems, follow manufacturer's specifications for correct blocking and bearing requirements.
10. Refer to the approved engineered layout drawings for engineered floor joist and roof truss systems, including beams and supports. Follow manufacturers specifications for bridging, bracing, bearing and connection requirements for built up beams or joists.
11. Tie the lower ends of roof rafters with continuous horizontal ties to the opposing rafters unless lateral thrust is otherwise specifically designed for.
12. Guards shall be constructed in accordance with Supplementary Standard 7 of the OBC or in conformance with OBC Part 4 (including design loads on guards). Min. guard height to comply with OBC 9.8.8. All guards to be non-climbable.
13. All masonry veneer ties shall be corrosion-resistant, minimum of 0.76 mm (0.03") thick, 22 mm (7/8") wide and be spaced in accordance with Table 9.20.9.5 of the OBC
14. Ceramic floor tile and its supporting floor shall be constructed in accordance to OBC 9.30.6.
15. For insulation values, window and door U-values and efficiency of appliances refer to SB-12 requirements: Prescriptive or Performance design or values specified by Energy Star requirements.
16. Foundation walls enclosing heated spaces shall be insulated to not more than 8" above the basement slab and an approved drainage layer is required on the exterior.
17. Exterior Insulated Finished System (EIFS) over wood framed wall and other moisture sensitive substrates shall consist of dual barrier with drained joints (DB/DJ). They shall be constructed in accordance to OBC 9.27.13 and shall conform to CAN/ULC-S716.1. All other exterior applied stucco finishes shall be constructed in accordance with OBC 9.28.
18. Stairs serving a house or dwelling unit shall have min. headroom of 1950 mm (6'-5"), min. width of 860 mm (2'-10"), max. rise of 200 mm (7 7/8") & min. 125 mm (4 7/8") and a min. run of 255 mm (10"). Tapered stairs shall have a min. average run of 255 mm (10") at the point of 300mm measured from the center of the handrail. The tolerance of stair dimensions shall conform to OBC 9.8.4.4. Secure stair stringers at top and bottom.
19. Basement ceiling height shall be min. 2.1 m (6'-11") over at least 75% of the area and 1.95 m (6'-5") under beams and ducts.
20. Every floor level containing a bedroom shall be provided with at least 1 outside window with an operable unobstructed opening having a minimum area of 0.35 sq. m. (3.8 sq. ft.), with no dimension less than 380 mm (15"). Every floor level, requiring travel of more than 1 storey to an exit door, shall be provided with an unobstructed escape window opening of not less than 1 m. (3'-3") in height and 0.55 m (21 5/8") in width with the sill not more than 1 m (3'-3") above the floor and 7 m. (23') above adjacent ground level or that floor shall be provided with a balcony. Except for basement locations, all windows shall have a maximum sill height of 1 m. (3'-3") above the floor.
21. Provide window protection to minimize the hazard to children in accordance with OBC 9.7.1.6.
22. Exterior walls, which are less than 1.2 m (4'-0") from the lot line, shall have no unprotected opening and be constructed with a 3/4 hr. fire resistance rating. These walls shall be rated from the interior. Exterior walls, which are less than 0.6 m (2'-0") from the lot line, shall in addition have non-combustible cladding.
23. All entrance doors, doors between the dwelling unit and the attached garage, patio doors and windows within 2m (6'-7") of adjacent ground level shall conform to OBC Subsections 9.6.8 & 9.7.6 'Resistance to Forced Entry'.
24. Roof vents shall be provided on the basis of 1 sq. ft./300 sq. ft. of insulated ceiling area. Where the roof slope is less than 1 in 6 or in cathedral ceilings, roof vents shall be provided on the basis of 1 sq. ft./150 sq. ft. of insulated ceiling area. Roof vents shall be uniformly distributed to ventilate each roof space with a minimum of 25% of the required vent space to be located at the top and the bottom of the roof.
25. Eave protection is required, beneath the start strip, from the edge of the roof to a minimum distance of 900 mm (3'-0") up the roof slope to not less than 300 mm (12") inside the inner face of the exterior wall on shingled, shake or tile roofs except as provided by 9.26.5.1.(2).
26. Foamed plastic insulation shall be protected with interior finishes according to OBC 9.10.17.10.
27. The wall and ceiling between an attached garage and the dwelling unit shall be constructed and sealed so as to provide an effective barrier to exhaust fumes. Door between the garage and the dwelling unit shall be tight fitting, weather-stripped and equipped with a self closing device.
28. Smoke alarms shall be provided on each floor level and be located within each bedroom. Smoke alarms shall be interconnected and hard wired with no disconnect switch. Smoke alarms are required to have a visual signaling component conforming to NFPA 72.
29. A carbon monoxide detector conforming to CAN/CGA-6.19 or UL 2034 shall be installed on every building containing a fuel burning appliance or an attached garage in conformance with the OBC 9.33.4.
30. In addition to the above carbon monoxide detectors, Town of Richmond Hill By-law No. 245-99 requires that a carbon monoxide detector, equipped with an alarm that is audible within bedrooms when the intervening doors are closed and conforming to CAN/CGA-6.19 or UL 2034, be installed in accordance with the manufacturer's instructions in every dwelling unit. Where the carbon monoxide detector is electrically powered, it must be approved by the Canadian Standards Association and be equipped with a visual indicator indicating that it is in operating condition and have NO switch between the carbon monoxide alarm and the power distribution panel.
31. A mechanical ventilation system is required in every dwelling. An exhaust only' ventilation system is permitted only where forced air heating is used, there is no electric heating or fireplace (other than a direct vent gas fireplace), and where a mechanically vented induced draft or direct vented furnace and hot water tank are used. A ventilation system with a heat recovery ventilator or Part 6 design is required in all other cases.
32. All exterior doors greater than 600mm above grade which do not exit onto a deck shall be permanently adjusted to prevent opening as per 9.6.4.1(2) of the OBC or be guarded as per 9.8.8 of the OBC
33. The main bathroom shall have stud reinforcement to accommodate future installation of grab bars adjacent to water closets and shower or bathtub as per OBC 9.5.2.3.
34. Slopes on roof surfaces shall comply with OBC 9.26.3.1.
35. Windows shall comply with OBC 9.7
36. Exhaust ducts connected to laundry drying equipment shall comply with OBC 6.2.3.8. (7)

CONSTRUCTION NOTES (UNLESS OTHERWISE NOTED)
ALL CONSTRUCTION TO ADHERE TO THESE PLANS AND
SPEC'S AND TO CONFORM TO THE ONTARIO BUILDING
current CODE AND ALL OTHER APPLICABLE CODES AND
AUTHORITIES HAVING JURISDICTION. THESE REQUIREMENTS
ARE TO BE TAKEN AS MINIMUM SPECIFICATIONS. ONT.
REG. 332/12 - 2012 OBC.

1 ROOF CONSTRUCTION (*SEE OBC 9.19.)
NO. 210 (10.25kg/m2) ASPHALT SHINGLES. 10mm (3/8")
PLYWOOD SHEATHING WITH "H" CLIPS. APPROVED WOOD
TRUSSES @600mm 24" o.c. MAX. APPROVED EAVE
PROTECTION TO EXTEND 900mm (3'-0") FROM EDGE OF
ROOF AND MIN. 300mm (12") BEYOND INNER FACE OF
EXTERIOR WALL, 38x89 (2"x4") TRUSS BRACING @ 1830mm
(6'-0") o.c. AT BOTTOM CHORD. PREFIN. ALUM.
EAVESTROUGH, FASCIA, RAIL & VENTED SOFFIT. PROVIDE
ICE & WATER SHIELD TO ALL ROOF / WALL SURFACES
SUSCEPTIBLE TO DAMMING. ROOF SHEATHING TO BE
FASTENED 150 (6") c.c. ALONG EDGES & INTERMEDIATE
SUPPORTS WHEN TRUSSES SPACED GREATER THAN 406
(16"). ATTIC VENTILATION 1:300 OF INSULATED CEILING
AREA WITH 50% AT EAVES.

2 FRAME WALL CONSTRUCTION (2"x6")
SIDING, HARDIE BOARD, STUCCATO BOARD OR EQUAL AS
PER ELEVATION, 19x64 (1"x3") VERTICAL WOOD FURRING,
APPROVED SHEATHING PAPER, 7/16" O.S.B. EXTERIOR
SHEATHING. 38x140 (2"x6") STUDS @ 400MM (16") o.c.
W/APPROVED DIAGONAL WALL BRACING, RSI 3.81 (R22)
INSULATION AND APPROVED VAPOUR BARRIER AND
APPROVED CONT. AIR BARRIER, 13mm (1/2") INT. DRYWALL
FINISH.

3 BRICK VENEER CONSTRUCTION (2"x6")
90mm (4") FACE BRICK 25mm (1") AIR SPACE,
22x180x0.76mm (1/8"x1"x0.03") GALV. METAL TIES @
400mm (16") o.c. HORIZONTAL 600mm (24") o.c. VERTICAL.
APPROVED SHEATHING PAPER, 7/16" O.S.B. EXTERIOR
SHEATHING. 38x140 (2"x6") STUDS @ 400mm (16") o.c.
W/APPROVED DIAGONAL WALL BRACING, RSI 3.81 (R22)
INSUL. APPROVED VAPOUR BARRIER AND APPROVED
CONT. AIR BARRIER, 13mm (1/2") INT. DRYWALL FINISH.
PROVIDE KNEE HOLES @ 800mm (32") o.c. BOTTOM
COURSE AND OVER OPENINGS, PROVIDE BASE
FLASHING UP MIN. 150mm (6") BEHIND BUILDING PAPER.

3A STUCCO WALL CONSTRUCTION (2"x6")
STUCCO CLADDING SYSTEM CONFIRMING TO OBC 9.27.1.1.(2)
& 9.28 THAT EMPLOY A MINIMUM 6mm (1/4") DRAINAGE
CAVITY BEHIND THE CLADDING WITH POSITIVE DRAINAGE
TO THE EXTERIOR AND APPLIED AS PER MANUFACTURERS
SPECIFICATION ON 25mm (1") MINIMUM EXTRUDED OR
EXPANDED RIGID INSULATION, APPROVED SHEATHING
PAPER, 7/16" O.S.B. EXTERIOR SHEATHING. 38x140 (2"x6")
STUDS @ 400mm (16") o.c. W/APPROVED DIAGONAL WALL
BRACING, RSI 3.81 (R22) INSUL. APPROVED VAPOUR
BARRIER AND APPROVED CONT. AIR BARRIER, 13mm (1/2")
INT. DRYWALL FINISH. STUCCO TO BE MIN. 200mm (8")
ABOVE FINISH GRADE.

4 INTERIOR STUD PARTITIONS
(*SEE OBC 9.23.10.&9.23.11.)
BEARING PARTITION 38x89 (2"x4") @ 400mm (16") o.c.
FOR 2 STOREYS AND 300mm (12") o.c. FOR 3 STOREYS.
NON-BEARING PARTITIONS 38x89 (2"x4") @ 600mm (24")
o.c.. PROVIDE 38x89 (2"x4") BOTTOM PLATE AND
2/38x89 (2-2"x4") TOP PLATE. 13mm (1/2") INTERIOR
DRYWALL BOTH SIDES OF STUD, PROVIDE 38x140 (2"x6")
STUDS/PLATES WHERE NOTED.

5 FOUNDATION WALL/FOOTINGS:
(*SEE OBC 9.15.3 & 9.15.4.)
MIN. 200mm (8") POURED CONC. FDTN. WALL 15MPa
(2200psi) WITH BITUMENOUS DAMPROOFING AND
DRAINAGE LAYER. MIN. 480x155 (19"x6") CONTIN. KEYED
CONC. FTG. BRACE FOUNDATION WALL PRIOR TO
BACKFILLING. ALL FOOTINGS SHALL REST ON NATURAL
UNDISTURBED SOIL WITH MINIMUM BEARING CAPACITY OF
120kPa (17.4 psi) OR GREATER.



6 WEEPING TILE (*SEE OBC 9.14.3.)
100mm (4") DIA. WEEPING TILE 150mm (6") CRUSHED STONE
OVER AND AROUND WEEPING TILES.

7 BASEMENT SLAB (*SEE OBC 9.16.)
80mm (3") MIN. 25MPa (3600psi) CONC. SLAB ON 100mm
(4") COARSE GRANULAR FILL, OR 15MPa (2200psi) CONC.
WITH DAMPROOFING BELOW SLAB.

8 WOOD SUBFLOORS (*SEE OBC 9.23.14. & 9.30.2.)
19mm (3/4") T&G SUBFLOOR UNDER GROUND FLOOR FINISH
FLOOR. 16mm (5/8") T&G SUBFLOOR UNDER SECOND
FLOOR FINISH FLOOR. 16mm (5/8") PANEL-TYPE
UNDERLAY FOR CERAMIC TILE APPLICATION. 6mm (1/4")
PANEL-TYPE UNDERLAY UNDER RESILIENT & PARQUET
FLOORING.

9 ROOF INSULATION (*SEE SB12-2.1.1.2.A & 2.1.1.7)
RSI 10.57 (R60) ROOF INSULATION AND APPROVED
VAPOUR BARRIER, 16mm (5/8") INT. DRYWALL FINISH OR
APPROVED EQUAL.

10 ALL STAIRS/EXTERIOR STAIRS (*SEE OBC 9.8.)
MAX. RISE = 200 (7-7/8")
MIN. RUN = 255 (10")
MAX. RUN/TREAD = 355 (14")
MAX. NOSING = 25 (1")
MIN. HEADROOM = 1950 (6'-5")
RAIL @ LANDING = 900 (2'-11")
RAIL @ STAIR = 865 (2'-10") TO 965 (3'-2")
MIN. STAIR WIDTH = 860 (2'-10")

FOR CURVED STAIRS
MIN. AVG. RUN = 200 (8")
MIN. RUN = 150 (6")

11 RAILING (*SEE OBC 9.8.8.)
FINISHED RAILING ON PICKETS SPACED MAXIMUM 100mm
(4") BETWEEN PICKETS.

INTERIOR GUARDS: = 900mm (2'-11") MIN.
EXTERIOR GUARDS: = 1070mm (3'-6") MIN.

12 SILL PLATE (*SEE OBC 9.23.6 & 9.23.7.)
38x89 (2"x4") SILL PLATE WITH 13mm (1/2") DIA. ANCHOR
BOLTS 200mm (8") LONG, EMBEDDED MIN. 100mm (4") INTO
CONC. @ 2400mm (7'-10") o.c. CAULKING OR 25 (1") MIN.
MINERAL WOOL BETWEEN PLATE AND TOP OF FDTN. WALL.
USE MORTAR TO LEVEL SILL PLATE WHEN REQUIRED.

13 BASEMENT INSULATION (*SEE OBC 12.3.)
FOUNDATION WALLS ENCLOSING HEATED SPACE SHALL BE
INSULATED FROM THE UNDERSIDE OF THE SUBFLOOR TO
NOT MORE THAN 152mm (6") ABOVE THE FINISHED FLOOR
OF THE BASEMENT AND NOT LESS THAN 50mm (2") TO THE
SLAB. continuous
FOUNDATION WALL INSULATION SHALL BE MINIMUM RSI.
3.52 (R20) BLANKET INSULATION, APPROVED VAPOUR
BARRIER, DAMPROOFING WBLDG. PAPER BETWEEN THE
FDTN. AND INSUL.

14 BASEMENT BEARING STUD PARTITION
(*SEE OBC 9.23.10.)
38x89 (2"x4") STUDS @400mm (16") o.c. 38x89 (2"x4") SILL
PLATE ON DAMPROOFING MATERIAL, 13mm (1/2") DIA.
ANCHOR BOLTS 200mm (8") LONG, EMBEDDED MIN. 100mm
(4") INTO CONC. @ 2400mm (7'-10") o.c. (4") HIGH CONC.
CURB ON 305x155 (12"x6") CONC. FOOTING. ADD HORIZ.
BLOCKING AT MID-HEIGHT IF WALL IS UNFINISHED.

15 STEEL BASEMENT COLUMN (*SEE OBC 9.17.3.)
90mm (3-1/2") DIA. x 4.78mm (188) STL. COL. WITH
150x150x4.5mm (6"x6"x3/8") STL. TOP & BOTTOM PLATE.

15A STEEL COLUMN (*SEE OBC 9.17.3.)
90mm (3-1/2") DIA. x 4.78mm (188) STL. COLUMN WITH
100x100x6.4mm (4"x4"x1/4") STEEL TOP & BOTTOM PLATE.
FIELD WELD BOTTOM PLATE TO 250x100x12.5mm
(10"x4"x1/2") BASE PLATE C/M 2-13mm (1/2") DIA. x 300mm
(12") LONG x 50mm (2") HOOK ANCHORS.

16 NIB WALLS (*SEE OBC 9.23.8.)
BEAM POCKET OR 200x200 (8"x8") POURED CONCRETE
NIB WALLS. MINIMUM BEARING 90mm (3-1/2")

17 STEEL BEAM STRAPPING (*SEE OBC 9.23.4.3.(3)(c))
19x38 (1"x2") CONTINUOUS WOOD STRAPPING BOTH SIDES
OF STEEL BEAM.

18 GARAGE SLAB (*SEE OBC 9.16.)
100mm (4") 32MPa (4640psi) CONC. SLAB WITH 5-8% AIR
ENTRAINMENT ON OPT. 100 (4") COARSE GRANULAR FILL
WITH COMPACTED SUB-BASE OR COMPACTED NATIVE
FILL. SLOPE TO FRONT 1% MIN.

19 INTERIOR GARAGE WALLS & CEILING
(*SEE OBC 9.10.9.16.)
13mm (1/2") GYPSUM BOARD ON WALL AND CEILING
BETWEEN HOUSE AND GARAGE, RSI 3.81 (R22) IN WALLS,
RSI 5.46 (R31) IN CEILING. TAPE AND SEAL ALL JOINTS
GAS TIGHT.

20 GARAGE DOOR GASPROOFING
(*SEE OBC 9.10.13.15.)
DOOR AND FRAME GASPROOFING. DOOR EQUIPPED WITH
SELF CLOSING DEVICE AND WEATHER STRIPPING.

21 EXTERIOR STEP (max. 2 risers for precast)
(*SEE OBC 9.8.9.2, 9.8.9.3 & 9.8.10.)
PRECAST CONCRETE STEP OR WD. STEP WHERE NOT
EXPOSED TO WEATHER MAX. RISE 200mm (7-7/8");
MINIMUM TREAD 250mm (9-1/2")

22 DRYER VENT (*SEE OBC 6.2.3.8.(7))
CAPPED DRYER EXHAUST VENTED TO EXTERIOR. USE
1000mm (4") DIA. SMOOTH WALL VENT PIPE.

23 ATTIC ACCESS (*SEE OBC 9.19.2.)
ATTIC ACCESS HATCH 545x700 (22"x28") WITH
WEATHERSTRIPPING. RSI 5.46 (R31) RIGID INSULATION
BACKING.

24 FIREPLACE CHIMNEYS (*OBC 9.21.)
TOP OF FIREPLACE CHIMNEY SHALL BE 915mm (3'-0")
ABOVE THE HIGHEST POINT AT WHICH IT COMES IN
CONTACT WITH THE ROOF AND 610mm (2'-0") ABOVE THE
ROOF SURFACE WITHIN A HORIZ. DISTANCE OF 3050mm
(10'-0") FROM THE CHIMNEY.

25 LINEN CLOSET
4 SHELVES MIN. 350mm (14") DEEP.

26 MECHANICAL EXHAUST
(*SEE OBC 9.32.3.5, 9.32.3.10.)
MECHANICAL EXHAUST FAN VENTED TO EXTERIOR.

27 STEEL BEARING PLATE FOR MASONRY WALLS
280x280x16 (11"x11"x5/8") STL. PLATE FOR STL BEAMS
AND 280x280x12 (11"x11"x1/2") STL. PLATE FOR WOOD
BEAMS BEARING ON CONC. BLOCK PARTYWALL,
ANCHORED W/ 2-19mm (3/4") x200mm (8") LONG GALV.
ANCHORS WITHIN SOLID BLOCK COURSE. LEVEL WITH
NON-SHRINK GROUT.

28 CLASS "B" VENT
U.L.C. RATED CLASS "B" VENT 610mm (2'-0") ABOVE THE
POINT IN CONTACT WITH THE ROOF FOR SLOPES UP TO
9/12, REFER TO THE ONTARIO GAS UTILIZATION CODE.

29 WOOD BASEMENT POST (*OBC 9.17.4.)
3-38x140 (3-2"x6") BUILT-UP POST ON METAL BASE SHOE
ANCHORED TO CONC. WITH 12.7 (1/2") DIA. BOLT ON
406x406x203 (16"x16"x8") CONC. FOOTING.

30 STEP FOOTINGS (*OBC 9.15.3.9.)
MIN. HORIZ. STEP = 610mm (24"). MAX. VERT. STEP =
610mm (24")

31 SLAB ON GRADE (*SEE OBC 9.16.)
100mm (4") 32MPa (4640psi) CONC. SLAB WITH 5-8% AIR
ENTRAINMENT ON OPT. 100 (4") COARSE GRANULAR FILL
WITH COMPACTED SUB-BASE OR COMPACTED NATIVE
FILL. REINFORCED W/ 6x6-W2.9xW2.9 MESH PLACED NEAR
MID-DEPTH OF SLAB.

32 DIRECT VENT FURNACE
DIRECT VENT FURNACE TERMINAL MIN. 900mm (36") FROM
A GAS REGULATOR, MIN 300mm (12") ABOVE FIN. GRADE,
FROM ALL OPENINGS, EXHAUST & INTAKE VENTS. HRV
INTAKE TO BE A MIN. OF 1830mm (6'-0") FROM ALL
EXHAUST TERMINALS. REFER TO GAS UTILIZATION CODE.

33 DIRECT VENT GAS FIREPLACE
DIRECT VENT GAS FIREPLACE, VENT TO BE A MINIMUM
300mm (12") FROM ANY OPENING AND ABOVE FIN. GRADE.
REFER TO GAS UTILIZATION CODE

34 JOIST STRAPPING & BRIDGING (*SEE OBC 23.9.4.)
ALL FLOOR JOISTS TO BE BRIDGED WITH 38x38 (2"x2")
CROSS BRACING OR SOLID BLOCKING @2100mm (6'-11")
o.c. MAX. 19x64 (1"x3") @2100mm (6'-11") o.c. UNLESS A
PANEL TYPE CEILING FINISH IS APPLIED.

35 EXPOSED BUILDING FACE (*SEE OBC 9.10.15.)
EXTERIOR WALLS TO HAVE A FIRE RESISTANCE RATING
OF NOT LESS THAN 45min. WHERE LIMITING DISTANCE IS
LESS THAN 1.2M (3'-11") WHERE THE LIMITING DISTANCE IS
LESS THAN 600mm (1'-11") THE EXPOSING FACE SHALL BE
CLAD IN NON-COMBUSTABLE MATERIAL.

36 GOLF CELLAR PORCH SLAB (*SEE OBC 9.40.)
FOR MAX. 2500mm (8'-2") PORCH DEPTH, 125mm (5") 32MPa
(4640 psi) CONC. SLAB WITH 5-8% AIR ENTRAINMENT.
REINF. WITH 10M BARS @200mm (8") o.c. EACH WAY IN
BOTTOM THIRD OF SLAB, ANCHORED IN PERIMETER FDTN.
WALLS W/ 610x610 (24"x24") 10M @600mm (24") o.c.
DOWELS. SLOPE SLAB MIN. 1.0% FROM DOOR. SLAB TO
HAVE A MIN. 75mm (3") BEARING ON FDTN. WALLS.
PROVIDE (W/L) LINTELS OVER CELLAR DOOR.

37 FDTN. WALL REDUCTION IN THICKNESS
(*SEE OBC 9.15.4.7.)
FDTN. WALL SHALL NOT BE REDUCED TO LESS THAN 90mm
(3-1/2") THICK TO A MAX. DEPTH OF 660mm (26") FOR 8"
FDTN. WALL. 10" FDTN. WALL WHEN REDUCTION IN
THICKNESS IS GREATER THAN 26". FDTN. WALL SHALL BE
TIED TO THE FACING MATERIAL WITH METAL TIES SPACED
200mm (8") o.c. VERTICALLY AND 900mm (36") o.c.
HORIZONTALLY. FILL SPACE BETWEEN WALL AND FACING
SOLID WITH MORTAR.

38 CONVENTIONAL ROOF FRAMING
(*SEE OBC 9.23.4.2.(1))
FOR MAX. 2240mm (7'-4") SPAN, 38x89 (2"x4") RAFTERS
@400mm (16") o.c.. FOR MAX. 3530mm (11'-7") SPAN,
38x140 (2"x6") RAFTERS @400mm (16") o.c.. RIDGE
BOARD TO BE 51mm (2") DEEPER. 38x39 (2"x4") COLLAR
TIES AT MIDSPANS. CEILING JOISTS TO BE 38x89 (2"x4")
@400mm (16") o.c. FOR MAX. 2830mm (9'-3") SPAN &
38x140 (2"x6") @ 400 (16") o.c. FOR MAX. 4450mm (14'-7")
SPAN. RAFTERS FOR BUILT-UP ROOF TO BE 38x89 (2"x4")
@600mm (24") o.c. WITH A 38x89 (2"x4") CENTER POST TO
THE TRUSS BELOW, LATERALLY BRACED @1800mm (6'-0")
o.c. VERTICALLY.

39 TWO STOREY VOLUME SPACES
FOR A MAXIMUM 5490mm (18'-0") HEIGHT, PROVIDE
2-38x140 (2-2"x6") CONTINUOUS STUDS @300mm (12") o.c.
FOR BRICK AND 400mm (16") o.c. FOR SIDING. PROVIDE
SOLID WOOD BLOCKING BETWEEN STUDS @1220mm (4'-0")
o.c. VERT. 7/16" EXT. PLYWOOD.

40 EXPOSED FLOOR TO EXTERIOR (*SB12-2.1.1.2.A)
PROVIDE RSI 5.46 (R31) INSULATION, APPROVED VAPOUR
BARRIER AND CONTINUOUS AIR BARRIER, FINISHED
SOFFIT.

41 PARTYWALLS
TYPICAL 1 HOUR RATED PARTYWALL. REFER TO DETAILS
FOR TYPE AND SPECIFICATIONS.

42 EXTERIOR WALLS FOR WALK-OUT CONDITION
THE EXTERIOR BASEMENT STUD WALL TO BE 38x140mm
(2"x6") STUDS @400mm (16") o.c. MATCH FLOOR JOIST
SPACING WHEN PARALLEL WITH FLOOR JOISTS.

43 SMOKE ALARM (*OBC 9.10.19)
WITHIN DWELLING UNITS, SUFFICIENT SMOKE ALARMS SHALL
BE INSTALLED SO THAT,
a. THERE IS AT LEAST ONE SMOKE ALARM INSTALLED ON
EACH STOREY, INCLUDING BASEMENTS AND
b. ON ANY STOREY OF A DWELLING UNIT CONTAINING
SLEEPING ROOMS, A SMOKE ALARM IS INSTALLED,
1. IN EACH SLEEPING ROOM, AND
2. IN A LOCATION BETWEEN THE SLEEPING ROOMS
AND THE REMAINDER OF THE STOREY, AND IF THE
SLEEPING ROOMS ARE SERVED BY A HALLWAY,
THE SMOKE ALARM SHALL BE LOCATED IN THE
HALLWAY.

A SMOKE ALARM SHALL HAVE A VISUAL SIGNALING
COMPONENT CONFORMING TO THE REQUIREMENTS IN B5.3.
(LIGHT, COLOR AND PULSE CHARACTERISTIC) OF NFPA 72,
"NATIONAL FIRE ALARM AND SIGNALING CODE".

A SMOKE ALARM SHALL BE INSTALLED IN CONFORMANCE
WITH CANULC-S553, "INSTALLATION OF SMOKE ALARMS".

SMOKE ALARMS SHALL BE INSTALLED ON OR NEAR THE
CEILING.

44 CARBON MONOXIDE ALARM (*OBC 9.33.4.)
WHERE A FUEL-BURNING APPLIANCE IS INSTALLED IN A
SUITE OF RESIDENTIAL OCCUPANCY, A CARBON
MONOXIDE ALARM SHALL BE INSTALLED TO EACH
SLEEPING AREA IN THE SUITE.

THE CARBON MONOXIDE ALARM SHALL
a. BE PERMANENTLY CONNECTED TO AN ELECTRICAL
CIRCUIT AND SHALL HAVE NO DISCONNECT SWITCH
BETWEEN THE OVERCURRENT DEVICE AND THE
CARBON MONOXIDE ALARM.
b. BE EQUIPPED WITH AN ALARM THAT IS AUDIBLE WITHIN
BEDROOMS WHEN THE INTERVENING DOORS ARE
CLOSED, WHERE LOCATED ADJACENT TO A SLEEPING
AREA, AND
c. CONFORM TO
1. CAN/CSA-6.19, "RESIDENTIAL CARBON
MONOXIDE ALARMING DEVICES", OR
2. UL2034, "SINGLE AND MULTIPLE STATION
CARBON MONOXIDE ALARMS"

45 SOIL GAS CONTROL (*OBC 9.13.4.)
PROVIDE CONSTRUCTION TO PREVENT LEAKAGE OF SOIL
GAS INTO THE BUILDING AS REQUIRED.

2012 CODE
COMPLIANCE PACKAGE "A1"

5.		
4.		
3.		
2.		
1.	ISSUED FOR PERMIT	JUL 30, 2018
REVISIONS		

The undersigned has reviewed and takes responsibility for this
design, and has the qualifications and meets the requirements set
out in the Ontario Building Code to be a designer.
QUALIFICATION INFORMATION
Required unless design is exempt under Division C, Subsection 3.2.5 of the building code
VIKAS GAJJAR
NAME
28770
SIGNATURE
BCIN

REGION DESIGN INC.
8700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4S6
P (416) 736-4096
F (905) 660-0746

REGION
DESIGN
INC.

SHEET TITLE GENERAL NOTES	
SCALE	N.T.S.
DATE	JULY 2018

CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.
PAGE No. 1

PROJECT NAME ROUNDEL

Greenpark
BUILDING DIVISION

09/22/2022

RECEIVED
Per: joshua.nabua

WINDOWS -
CANADA ZONE C

- (1) **MINIMUM BEDROOM WINDOW** (*OBC 9.9.10.1.)
AT LEAST ONE BEDROOM WINDOW ON A GIVEN FLOOR IS TO HAVE MIN. 0.35m² (3.8 SQ.FT.) UNOBSTRUCTED GLAZED OPENABLE AREA WITH MIN. CLEAR WIDTH OF 380mm (1'-3")
GLASS AREA NOT MORE THAN 17% OF GROSS PERIPHERAL WALL AREA.
MAXIMUM U-VALUE 0.28
- (2) **WINDOW GUARDS** (*OBC 9.8.8.1(6))
A GUARD IS REQUIRED WHERE THE TOP OF THE WINDOW SILL IS LOCATED LESS THAN 480mm (1'-6") ABOVE FIN. FLOOR AND THE DISTANCE FROM THE FIN. FLOOR TO THE ADJACENT GRADE IS GREATER THAN 1800mm (5'-11")

GENERAL:

- (1) **MECHANICAL VENTILATION**
MECHANICAL VENTILATION IS REQUIRED TO PROVIDE 0.3 AIR CHANGES PER HOUR AVERAGED OVER 24 HOURS. SEE MECHANICAL DRAWINGS.
- (2) **RAINFORCEMENT FOR GRAB BARS** (*OBC 9.5.2.3.)
RAINFORCEMENT OF STUD WALLS FOR FUTURE GRAB BARS SHALL BE INSTALLED ADJACENT TO WATER CLOSETS AND SHOWER OR BATHTUB IN MAIN BATHROOM. SEE DETAIL ON PAGE 11.

LUMBER:

- 1.) ALL LUMBER SHALL BE SPRUCE-PINE-FIR No.1&2 GRADE, UNLESS NOTED OTHERWISE.
- 2.) LUMBER EXPOSED TO THE EXTERIOR TO BE SPRUCE-PINE-FIR No.1&2 GRADE PRESSURE TREATED OR CEDAR, UNLESS NOTED OTHERWISE.
- 3.) ALL BEAMS, GIRDER TRUSSES, AND METAL HANGER CONNECTIONS SUPPORTING ROOF FRAMING TO BE DESIGNED & CERTIFIED BY TRUSS MANUFACTURER.
- 4.) LVL BEAMS SHALL BE 2.0E (Fb=2800psi MIN.). NAIL EACH PLY OF LVL WITH 89mm (3-1/2") LONG COMMON WIRE NAILS @300mm (12") o.c. STAGGERED IN 2 ROWS FOR 184, 240, & 300mm (7-1/4", 9-1/2", 11-7/8") DEPTHS AND STAGGERED IN 3 ROWS FOR GREATER DEPTHS AND FOR 4 PLY MEMBERS ADD 1/2" (13mm) DIA. GALVANIZED BOLTS BOLTED AT MID-DEPTH OF BEAM @ 915mm (3'-0") o.c.
- 5.) PROVIDE TOP MOUNT BEAM HANGERS FOR ALL LVL BEAM TO BEAM CONNECTIONS UNLESS NOTED OTHERWISE.
- 6.) PROVIDE METAL JOIST HANGERS FOR ALL JOISTS AND BUILT-UP WOOD MEMBERS INTERSECTING FLUSH BUILT-UP WOOD MEMBERS.
- 7.) WOOD FRAMING NOT TREATED WITH A WOOD PRESERVATIVE, IN CONTACT WITH CONCRETE, SHALL BE SEPARATED FROM THE CONC. BY AT LEAST 2mil. POLYETHYLENE FILM, No.50 (45lbs) ROLL ROOFING OR OTHER DAMPROOFING MATERIAL, EXCEPT WHERE THE WOOD MEMBER IS AT LEAST 150mm (6") ABOVE THE GROUND.

STEEL:

STRUCTURAL STEEL AND HOLLOW STRUCTURAL SECTIONS SHALL CONFORM TO CAN/CSA-G40-21 GRADE 350W.

REINFORCING STEEL SHALL CONFORM TO CSA-G30-18M GRADE 400R.

ELECTRIC VEHICLE CHARGING SYSTEM (EVCS):

ROUGH-IN FOR FUTURE VEHICLE SUPPLY EQUIPMENT (CHARGING SYSTEM) TO BE INSTALLED. ROUGH-IN SHALL INCLUDE:

- A MINIMUM 200amp PANEL BOARD,
- CONDUIT THAT IS NOT LESS THAN 1 1/16" (27mm) TRADE SIZE,
- A SQUARE 4 11/16" (119mm) TRADE SIZE ELECTRICAL OUTLET BOX,
- FUME-PROFFED ELECTRICAL OUTLET BOX TO BE INSTALLED IN THE GARAGE OR CARPORT OR ADJACENT TO DRIVEWAY.

REFER TO 2012 O.B.C. 9.34.4

STABILITY OF NARROW (20'-25')
& TALL (±30') HOUSES

BUILDER TO PROVIDE SUFFICIENT TEMPORARY BRACING TO RESIST WIND LOADING WHEN UNDER CONSTRUCTION. FURTHER RECOMMENDATIONS:

- 1.) REDUCE THE FOUNDATION WALL SILL PLATE ANCHOR BOLT SPACING FROM 2400mm o.c. (7'-10") TO 1220mm o.c. (4'-0") FOR STANDARD CONDITIONS.
- 2.) USE 9.5mm (3/8") THICK PLYWOOD OR WAFERBOARD FOR THE EXTERIOR WALL SHEATHING.
- 3.) TO STIFFEN THE STRUCTURE IN TRANSVERSE DIRECTION USE 9.5mm (3/8") THICK PLYWOOD NAILED TO THE INTERIOR PARTITIONS ON EACH FLOOR FOR A MINIMUM 2 INTERIOR PARTITION WALLS ON BOTH SIDES AND PERPENDICULAR TO THE LONG WALLS.

BRICK VENEER LINTELS

WL1 = 3-1/2"x3-1/2"x1/4"L (90x90x6.OL) + 2-2"x8" SPR. No.2
WL2 = 4"x3-1/2"x5/16"L (100x90x8.OL) + 2-2"x8" SPR. No.2
WL3 = 5"x3-1/2"x5/16"L (125x90x8.OL) + 2-2"x10" SPR. No.2
WL4 = 6"x3-1/2"x3/8"L (150x90x10.OL) + 2-2"x12" SPR. No.2
WL5 = 6"x4"x3/8"L (150x100x10.OL) + 2-2"x12" SPR. No.2
WL6 = 5"x3-1/2"x5/16"L (125x90x8.OL) + 2-2"x12" SPR. No.2
WL7 = 5"x3-1/2"x5/16"L (125x90x8.OL) + 3-2"x10" SPR. No.2
WL8 = 5"x3-1/2"x5/16"L (125x90x8.OL) + 3-2"x12" SPR. No.2
WL9 = 6"x4"x3/8"L (150x100x10.OL) + 3-2"x12" SPR. No.2

WOOD LINTELS AND BEAMS

WB1 = 2-2"x8" SPR. No.2 (2-38x184 SPR. No.2)
WB2 = 3-2"x8" SPR. No.2 (3-38x184 SPR. No.2)
WB3 = 2-2"x10" SPR. No.2 (2-38x235 SPR. No.2)
WB4 = 3-2"x10" SPR. No.2 (3-38x235 SPR. No.2)
WB5 = 2-2"x12" SPR. No.2 (2-38x286 SPR. No.2)
WB6 = 3-2"x12" SPR. No.2 (3-38x286 SPR. No.2)
WB7 = 5-2"x12" SPR. No.2 (5-38x286 SPR. No.2)
WB11 = 4-2"x10" SPR. No.2 (4-38x235 SPR. No.2)
WB12 = 4-2"x12" SPR. No.2 (4-38x286 SPR. No.2)

LOOSE STEEL LINTELS

L1 = 3-1/2"x3-1/2"x1/4"L (90x90x6.OL)
L2 = 4"x3-1/2"x5/16"L (100x90x8.OL)
L3 = 5"x3-1/2"x5/16"L (125x90x8.OL)
L4 = 6"x3-1/2"x3/8"L (150x90x10.OL)
L5 = 6"x4"x3/8"L (150x100x10.OL)
L6 = 7"x4"x3/8"L (175x100x10.OL)





LAMINATED VENEER LUMBER (LVL) BEAMS

LVL1A = 1-1 3/4" x 7 1/4" (1-45x184)
LVL1 = 2-1 3/4" x 7 1/4" (2-45x184)
LVL2 = 3-1 3/4" x 7 1/4" (3-45x184)
LVL3 = 4-1 3/4" x 7 1/4" (4-45x184)
LVL4A = 1-1 3/4" x 9 1/2" (1-45x240)
LVL4 = 2-1 3/4" x 9 1/2" (2-45x240)
LVL5 = 3-1 3/4" x 9 1/2" (3-45x240)
LVL5A = 4-1 3/4" x 9 1/2" (4-45x240)
LVL6A = 1-1 3/4" x 11 7/8" (1-45x300)
LVL6 = 2-1 3/4" x 11 7/8" (2-45x300)
LVL7 = 3-1 3/4" x 11 7/8" (3-45x300)
LVL7A = 4-1 3/4" x 11 7/8" (4-45x300)
LVL8 = 2-1 3/4" x 14" (2-45x356)
LVL9 = 3-1 3/4" x 14" (3-45x356)
LVL10 = 2-1 3/4" x 18" (2-45x456)

DOOR SCHEDULE


1 = 2'-10" x 6'-8" (865x2033) - INSULATED ENTRANCE DOOR
1a = 2'-8" x 6'-8" (815x2033) - INSULATED FRONT DOORS
2 = 2'-8" x 6'-8" (815x2033) - WOOD & GLASS DOOR
3 = 2'-8" x 6'-8" x 1-3/4" (815x2033x45) - EXTERIOR SLAB DOOR
4 = 2'-8" x 6'-8" x 1-3/8" (815x2033x35) - INTERIOR SLAB DOOR
5 = 2'-6" x 6'-8" x 1-3/8" (760x2033x35) - INTERIOR SLAB DOOR
6 = 2'-2" x 6'-8" x 1-3/8" (660x2033x35) - INTERIOR SLAB DOOR
7 = 1'-6" x 6'-8" x 1-3/8" (460x2033x35) - INTERIOR SLAB DOOR

LEGEND

DJ	DOUBLE JOIST
TJ	TRIPLE JOIST
GT	GIRDER TRUSS
	POINT LOAD
	SOLID WOOD BEARING. SOLID BEARING TO BE WIDE AT LEAST AS SUPPORTED MEMBER. MIN. 3 PIECES.
	LOAD-BEARING WALL
	TWO-STOREY WALL. SEE NOTE 39
	FLAT ARCH
F.D. 	FLOOR DRAIN
SA 	SMOKE ALARM. SEE NOTE 43
SA CMA 	SMOKE ALARM & CARBON MONOXIDE ALARM. SEE NOTE 44

STRUDET INC.




5.			The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. QUALIFICATION INFORMATION Required unless design is exempt under Division C, Subsection 3.2.5 of the building code VIKAS GAJJAR  28770 NAME SIGNATURE BCIN	REGION DESIGN INC. 8700 DUFFERIN ST. CONCORD, ONTARIO L4K 4S6 P (416) 736-4096 F (905) 660-0746	REGION DESIGN INC.	SHEET TITLE		CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.				
4.						GENERAL NOTES						
3.						SCALE	N.T.S.			PAGE No.	2	PROJECT NAME
2.												
1.	ISSUED FOR PERMIT	JAN 31, 2015										
REVISIONS												

CITY OF RICHMOND HILL
BUILDING DIVISION


09/22/2022

RECEIVED
Per: joshua.nabua



2012 CODE
COMPLIANCE PACKAGE "A1"

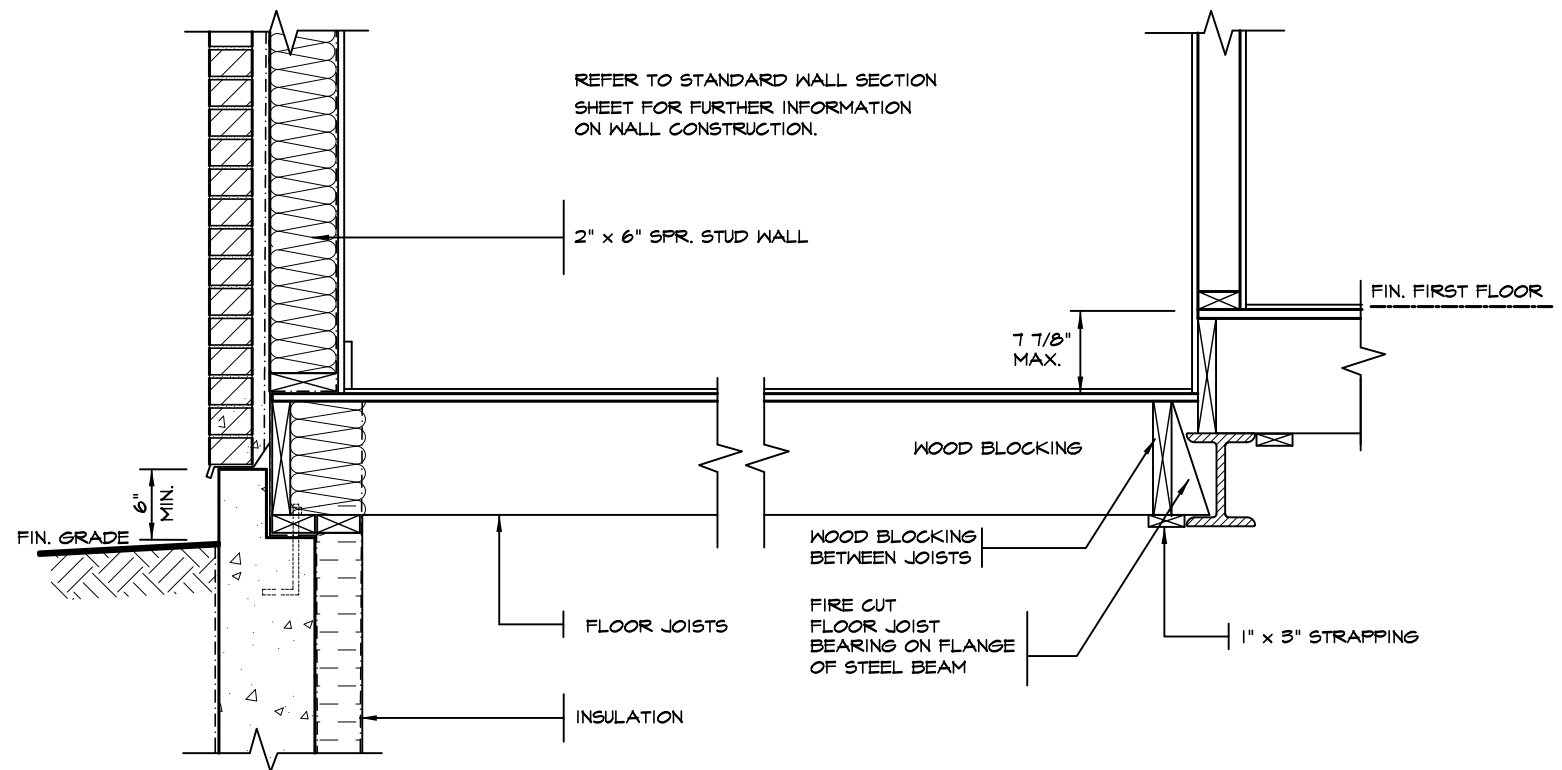

**DETAIL OF SUNKEN LAUNDRY
(ONE RISER)**

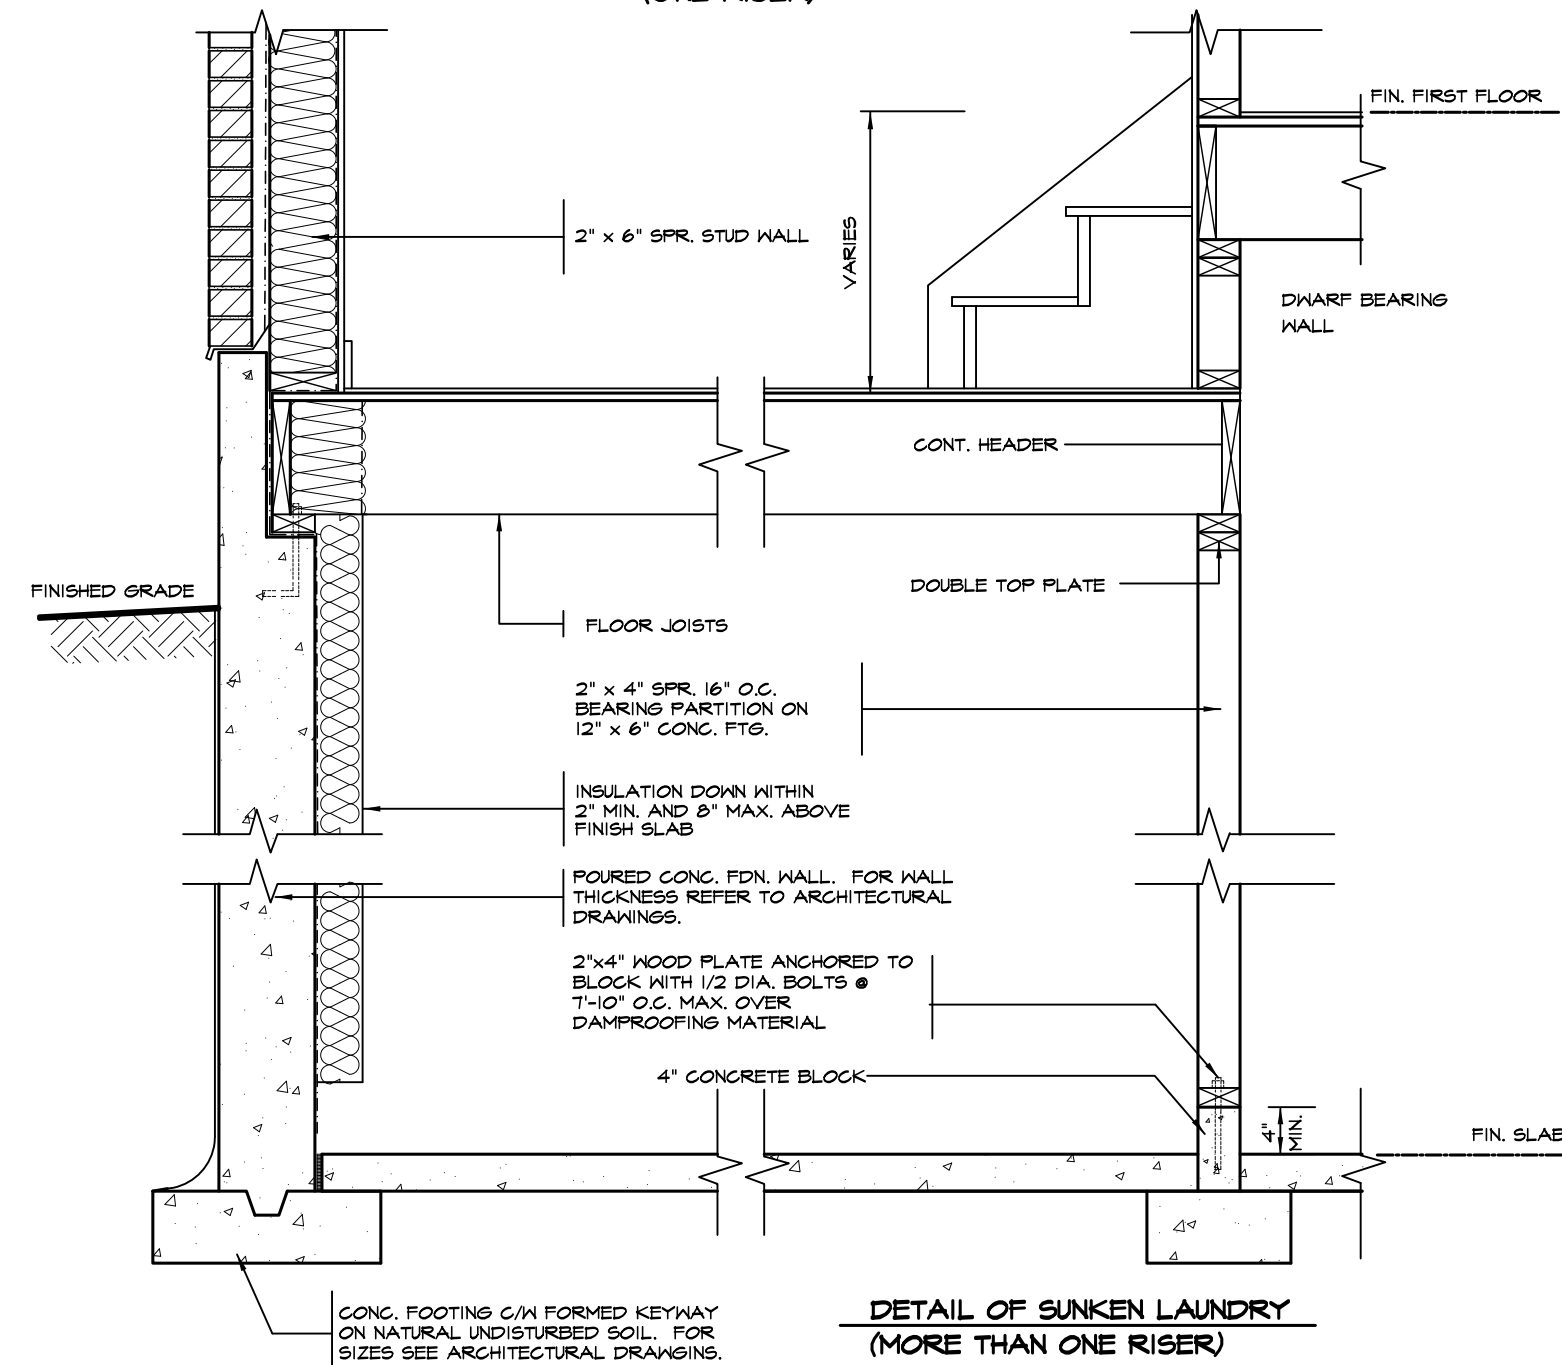

**DETAIL OF SUNKEN LAUNDRY
(MORE THAN ONE RISER)**

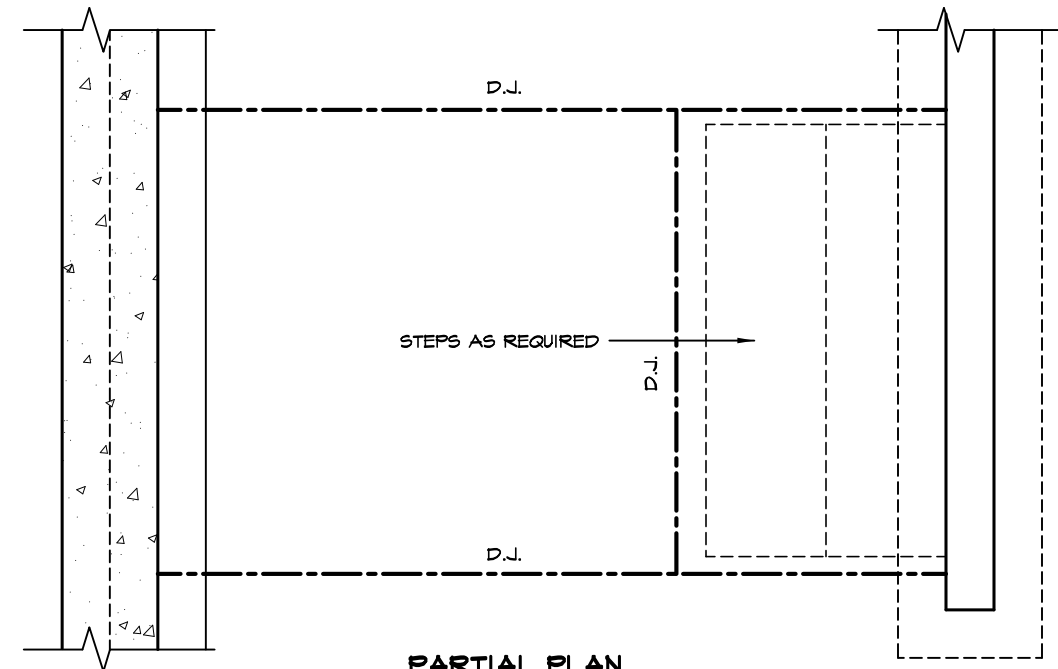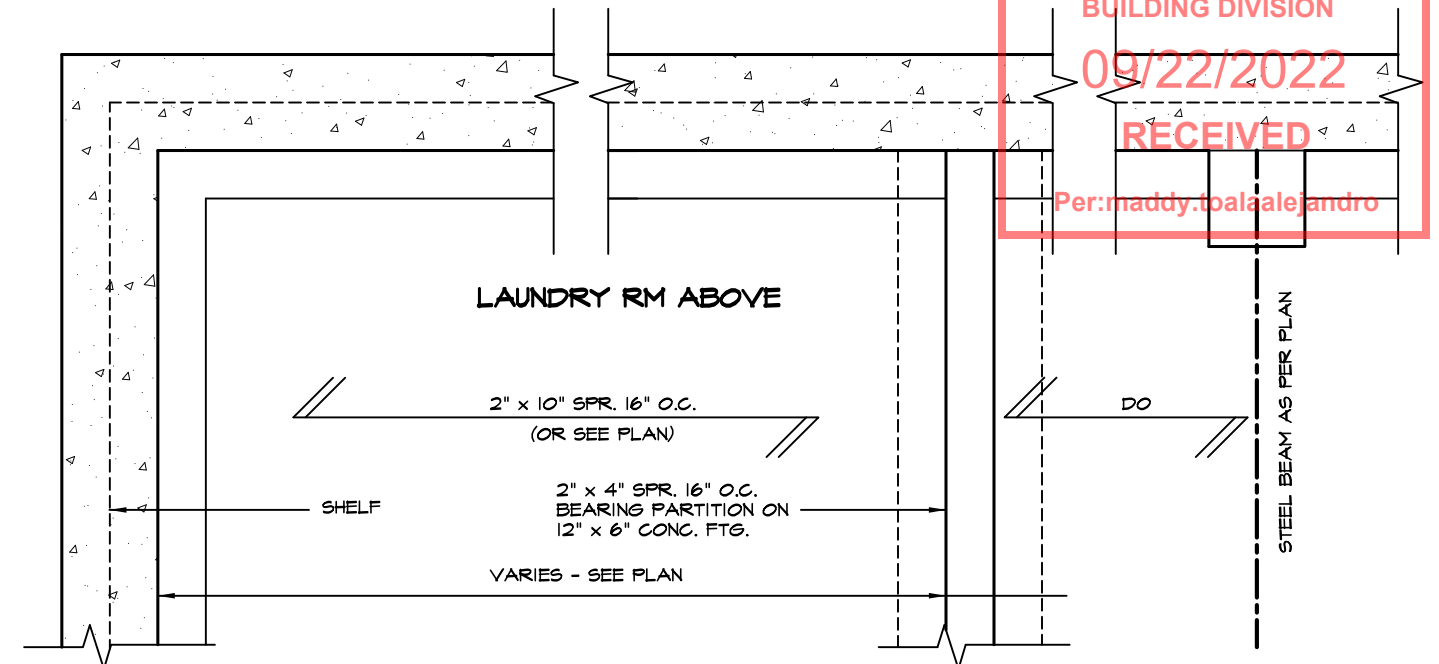

PARTIAL PLAN



FOR STRUCTURE ONLY
**2012 CODE
COMPLIANCE PACKAGE "A1"**

5.		
4.		
3.		
2.		
1.	ISSUED FOR PERMIT	JUL 30, 2018
REVISIONS		

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.		
QUALIFICATION INFORMATION		
Required unless design is exempt under Division C, Subsection 3.2.5 of the building code		
VIKAS GAJJAR	28770	BCIN
NAME	SIGNATURE	




REGION DESIGN INC.
8700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4S6
P (416) 736-4096
F (905) 660-0746



SHEET TITLE	
LAUNDRY DETAILS SUNKEN	
SCALE	3/4"=1'-0"
DATE	JULY 2018

CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.	
PAGE No.	5

PROJECT NAME	ROUNDEL

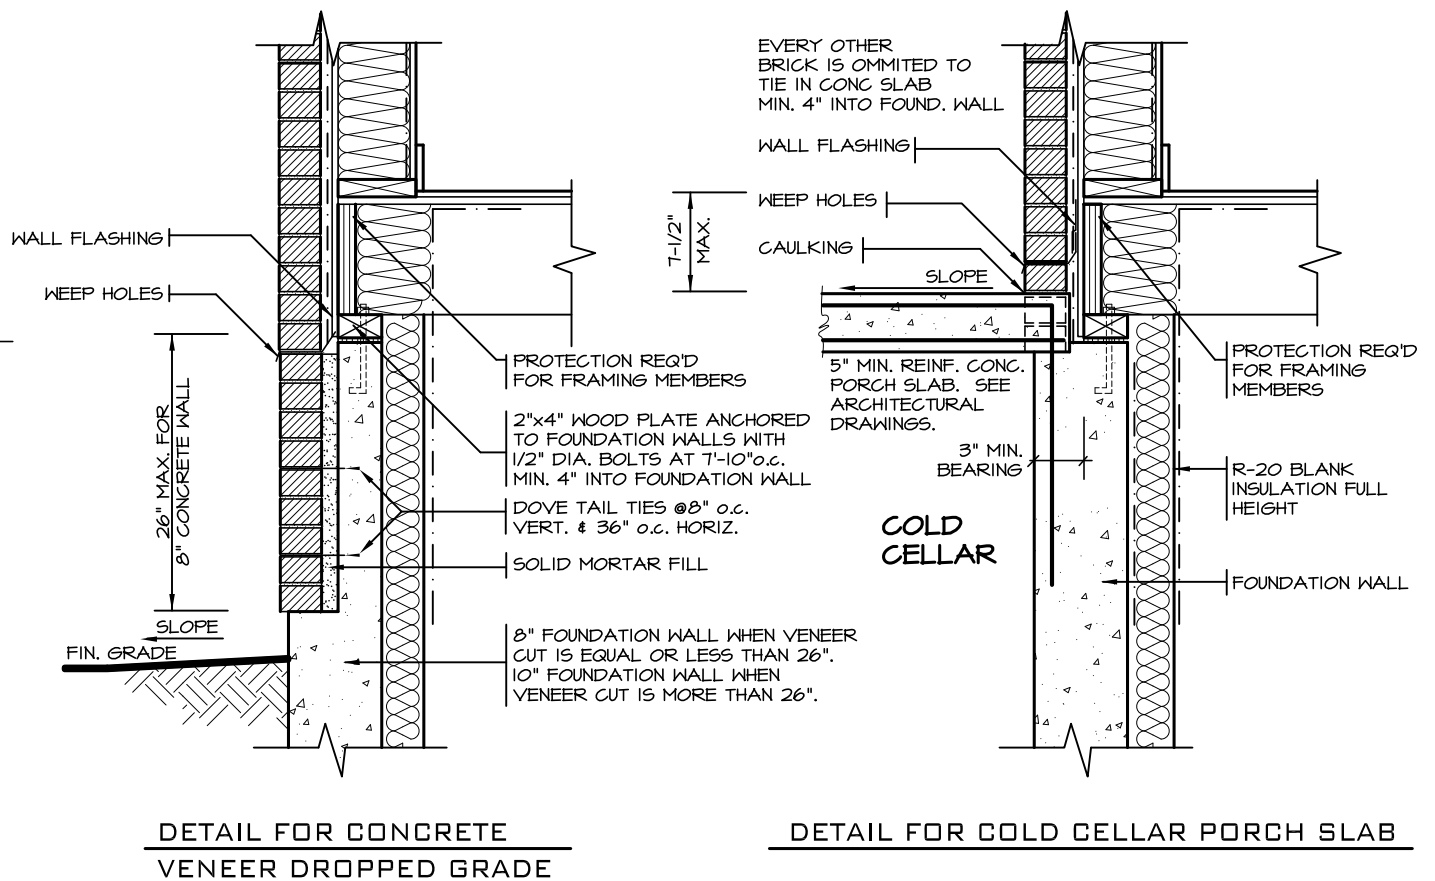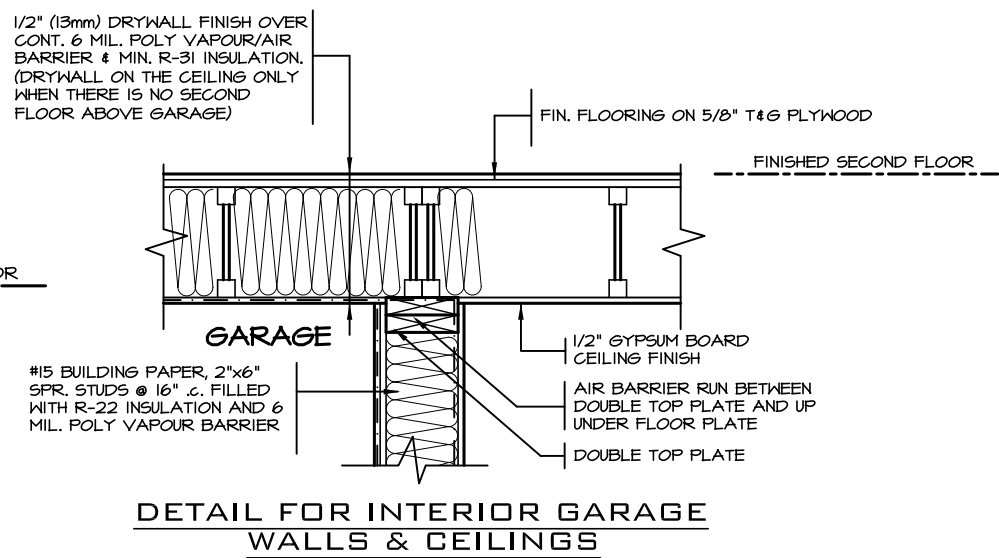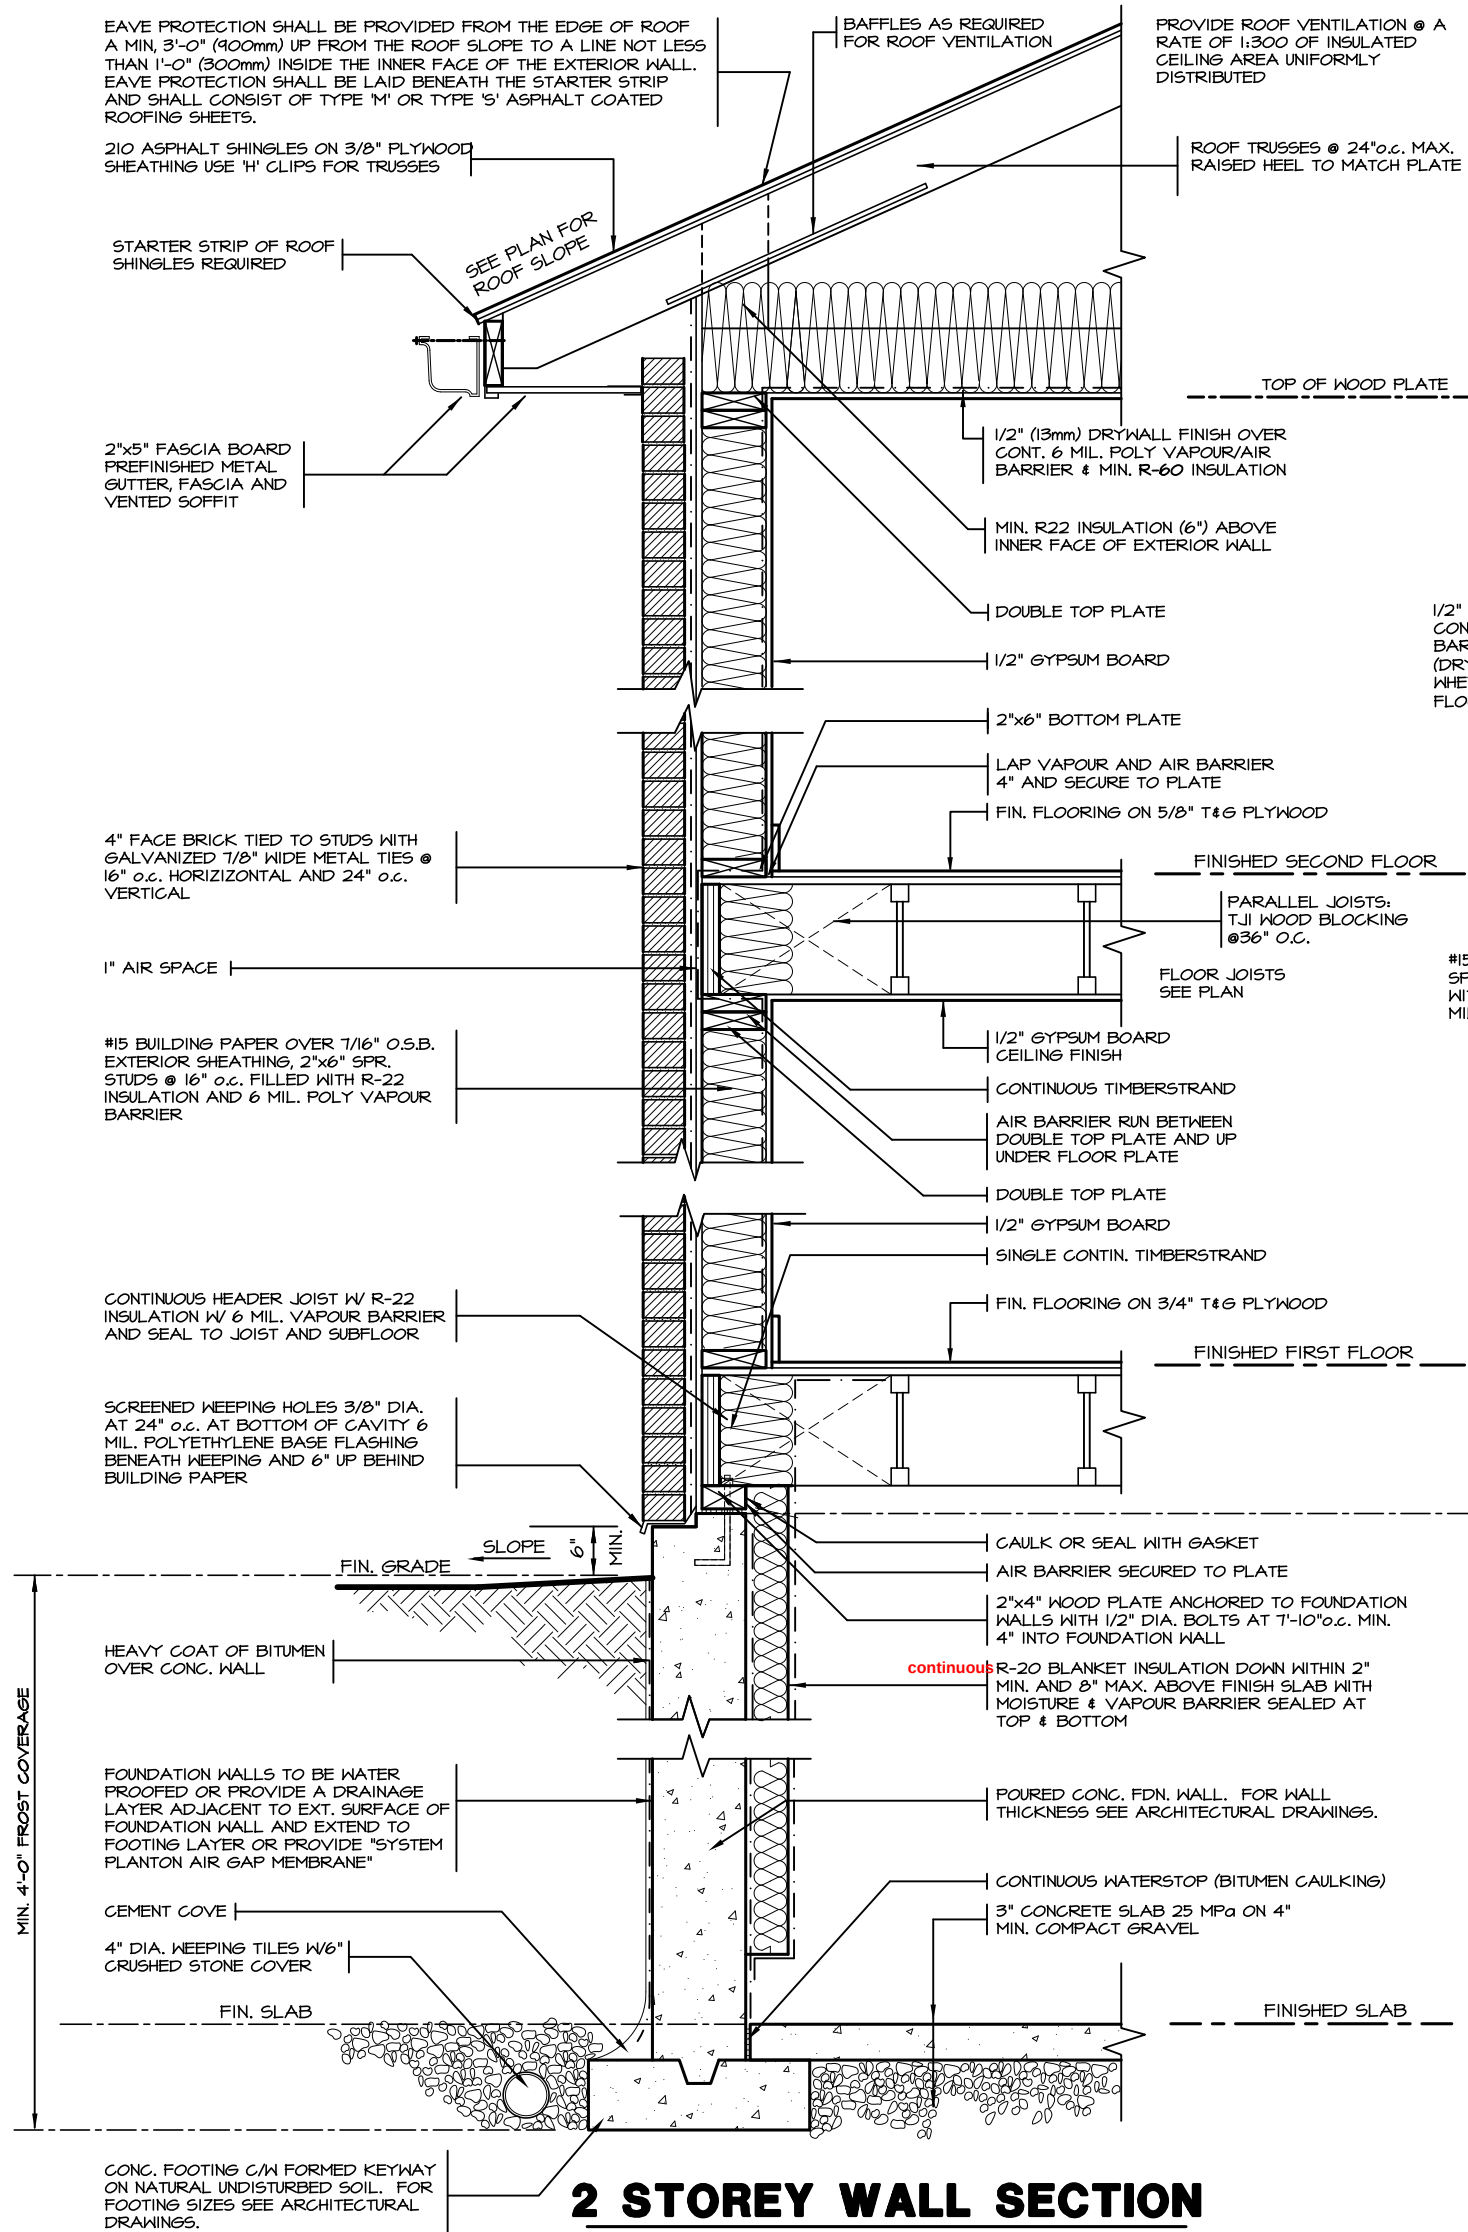

2012 CODE
COMPLIANCE PACKAGE "A1"

5.		
4.		
3.		
2.		
1.	ISSUED FOR PERMIT	JUL 30, 2018
REVISIONS		

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION
Required unless design is exempt under Division C, Subsection 3.2.5 of the building code

VIKAS GAJJAR
NAME

28770
BCIN

SIGNATURE

REGION DESIGN INC.
8700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4S6
P (416) 736-4096
F (905) 660-0746

REGION
DESIGN
INC.

SHEET TITLE
2"X6" BRICK VENEER
2 STOREY SECTION

SCALE
3/4"=1'-0"

DATE
JULY 2018

CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.

PAGE No.
6

PROJECT NAME
ROUNDEL

EAVE PROTECTION SHALL BE PROVIDED FROM THE EDGE OF ROOF A MIN. 3'-0" (900mm) UP FROM THE ROOF SLOPE TO A LINE NOT LESS THAN 1'-0" (300mm) INSIDE THE INNER FACE OF THE EXTERIOR WALL. EAVE PROTECTION SHALL BE LAID BENEATH THE STARTER STRIP AND SHALL CONSIST OF TYPE 'M' OR TYPE 'S' ASPHALT COATED ROOFING SHEETS.

210 ASPHALT SHINGLES ON 3/8" PLYWOOD SHEATHING USE 'H' CLIPS FOR TRUSSES

STARTER STRIP OF ROOF SHINGLES REQUIRED

SEE PLAN FOR ROOF SLOPE

BAFFLES AS REQUIRED FOR ROOF VENTILATION

PROVIDE ROOF VENTILATION @ A RATE OF 1:300 OF INSULATED CEILING AREA UNIFORMLY DISTRIBUTED

ROOF TRUSSES @ 24" O.C. MAX. RAISED HEEL TO MATCH PLATE

TOP OF WOOD PLATE

2"x5" FASCIA BOARD PREFINISHED METAL GUTTER, FASCIA AND VENTED SOFFIT

1 1/2"x6" RAISED STUCCO FRIEZE BOARD (TYP.)

MESH BACKWRAPPED

1/2" (13mm) DRYWALL FINISH OVER CONT. 6 MIL. POLY VAPOUR/AIR BARRIER & MIN. R-50 INSULATION

MIN. R22 INSULATION ABOVE INNER FACE OF EXTERIOR WALL

DOUBLE TOP PLATE

1/2" GYPSUM BOARD

2"x6" BOTTOM PLATE

LAP VAPOUR AND AIR BARRIER 4" AND SECURE TO PLATE

FIN. FLOORING ON 5/8" T&G PLYWOOD

FINISHED SECOND FLOOR

PARALLEL JOISTS: TJI WOOD BLOCKING @ 36" O.C.

FLOOR JOISTS SEE PLAN

- FIN. COAT OF EXTERIOR ACRYLIC STUCCO
- FIBER MESH EMBEDDED IN PREP COAT
- INSULATION BOARD (MIN. R5) W/ GEOMETRICALLY DEFINED DRAINAGE CAVITY HAVING A MIN. CAVITY DEPTH OF 1/4"
- AIR/MOISTURE BARRIER
- 1/16" EXTERIOR GRADE OSB SHEATHING
- 2" X 6" STUDS
- MIN. R-22 BATT INSULATION
- CONT. VAPOUR / AIR BARRIER
- 1/2" DRYWALL

(EIFS APPROVED SYSTEM, ALL MATERIALS AND SYSTEMS SHALL CONFORM TO CAN/ULC-5716.1)

CONCRETE SILL

CONTINUOUS HEADER JOIST W/ R-22 INSULATION W/ 6 MIL. VAPOUR BARRIER AND SEAL TO JOIST AND SUBFLOOR

4" FACE BRICK TIED TO STUDS WITH GALVANIZED 7/8" WIDE METAL TIES @ 16" O.C. HORIZONTAL AND 24" O.C. VERTICAL

SCREENED WEEPING HOLES 3/8" DIA. AT 24" O.C. AT BOTTOM OF CAVITY 6 MIL. POLYETHYLENE BASE FLASHING BENEATH WEEPINGS AND 6" UP BEHIND BUILDING PAPER

FIN. GRADE

SLOPE 6" MIN.

HEAVY COAT OF BITUMEN OVER CONC. WALL

FOUNDATION WALLS TO BE WATER PROOFED OR PROVIDE A DRAINAGE LAYER ADJACENT TO EXT. SURFACE OF FOUNDATION WALL AND EXTEND TO FOOTING LAYER OR PROVIDE "SYSTEM PLANTON AIR GAP MEMBRANE"

CEMENT COVE

4" DIA. WEEPING TILES W/ 6" CRUSHED STONE COVER

FIN. SLAB

CAULK OR SEAL WITH GASKET

AIR BARRIER SECURED TO PLATE

2"x4" WOOD PLATE ANCHORED TO FOUNDATION WALLS WITH 1/2" DIA. BOLTS AT 7'-10" O.C. MIN. 4" INTO FOUNDATION WALL

R-20 BLANKET INSULATION DOWN WITHIN 2" MIN. AND 8" MAX. ABOVE FINISH SLAB WITH MOISTURE & VAPOUR BARRIER SEALED AT TOP & BOTTOM

POURED CONC. FDN. WALL. FOR WALL THICKNESS SEE ARCHITECTURAL DRAWINGS.

CONTINUOUS WATERSTOP (BITUMEN CAULKING)

3" CONCRETE SLAB 25 MPa ON 4" MIN. COMPACT GRAVEL

FINISHED SLAB

2 STOREY WALL SECTION

STRUDET INC.



FOR STRUCTURE ONLY

WOOD SHEATHING

AIR/MOISTURE BARRIER

FIBRE MESH EMBEDDED IN PREP COAT

INSULATION BOARD (R-5) W/ GEOMETRICALLY DEFINED DRAINAGE CAVITY HAVING A MIN. CAVITY DEPTH OF 1/4"

STARTER MESH (BACKWRAPPED)

CAULK WITH BEAD VENT

FLASHING

CONCRETE SILL

MASONRY CLADDING AS PER ELEVATION

A. TERMINATION AT MASONRY CLADDING WITH SEALANT

1 1/2" = 1'0"

WALL FLASHING

WEEP HOLES

PROTECTION REQ'D FOR FRAMING MEMBERS

2"x4" WOOD PLATE ANCHORED TO FOUNDATION WALLS WITH 1/2" DIA. BOLTS AT 7'-10" O.C. MIN. 4" INTO FOUNDATION WALL

DOVE TAIL TIES @ 8" O.C. VERT. & 36" O.C. HORIZ.

SOLID MORTAR FILL

8" FOUNDATION WALL WHEN VENEER CUT IS EQUAL OR LESS THAN 26". 10" FOUNDATION WALL WHEN VENEER CUT IS MORE THAN 26".

DETAIL FOR CONCRETE VENEER DROPPED GRADE

EVERY OTHER BRICK IS OMITTED TO TIE IN CONC SLAB MIN. 4" INTO FOUND. WALL

WALL FLASHING

WEEP HOLES

CAULKING

SLOPE

5" MIN. REINF. CONC. PORCH SLAB. SEE ARCHITECTURAL DRAWINGS.

3" MIN. BEARING

R-20 BLANKET INSULATION FULL HEIGHT

FOUNDATION WALL

PROTECTION REQ'D FOR FRAMING MEMBERS

COLD CELLAR

DETAIL FOR COLD CELLAR PORCH SLAB

2012 CODE
COMPLIANCE PACKAGE "A1"

5.		
4.		
3.		
2.		
1.	ISSUED FOR PERMIT	JUL 30, 2018
REVISIONS		

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION

Required unless design is exempt under Division C, Subsection 3.2.5 of the building code

VIKAS GAJJAR

NAME

28770

BCIN

SIGNATURE

REGION DESIGN INC.

8700 DUFFERIN ST.

CONCORD, ONTARIO

L4K 4S6

P (416) 736-4096

F (905) 660-0746

REGION
DESIGN
INC.

SHEET TITLE

2"X6" STUCCO WALL
2 STOREY SECTION

SCALE

AS NOTED

DATE

JULY 2018

CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.





PAGE No.

6-2

Greenpark.

PROJECT NAME

ROUNDEL

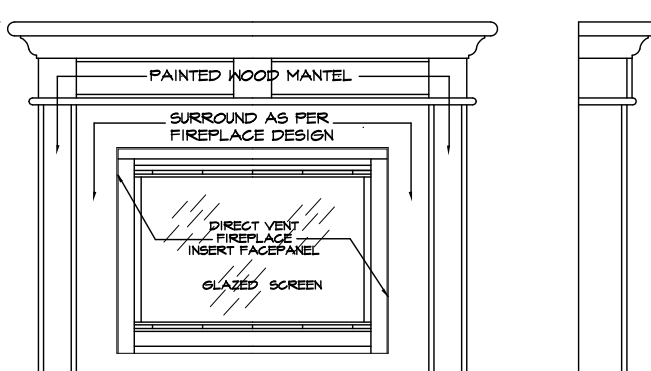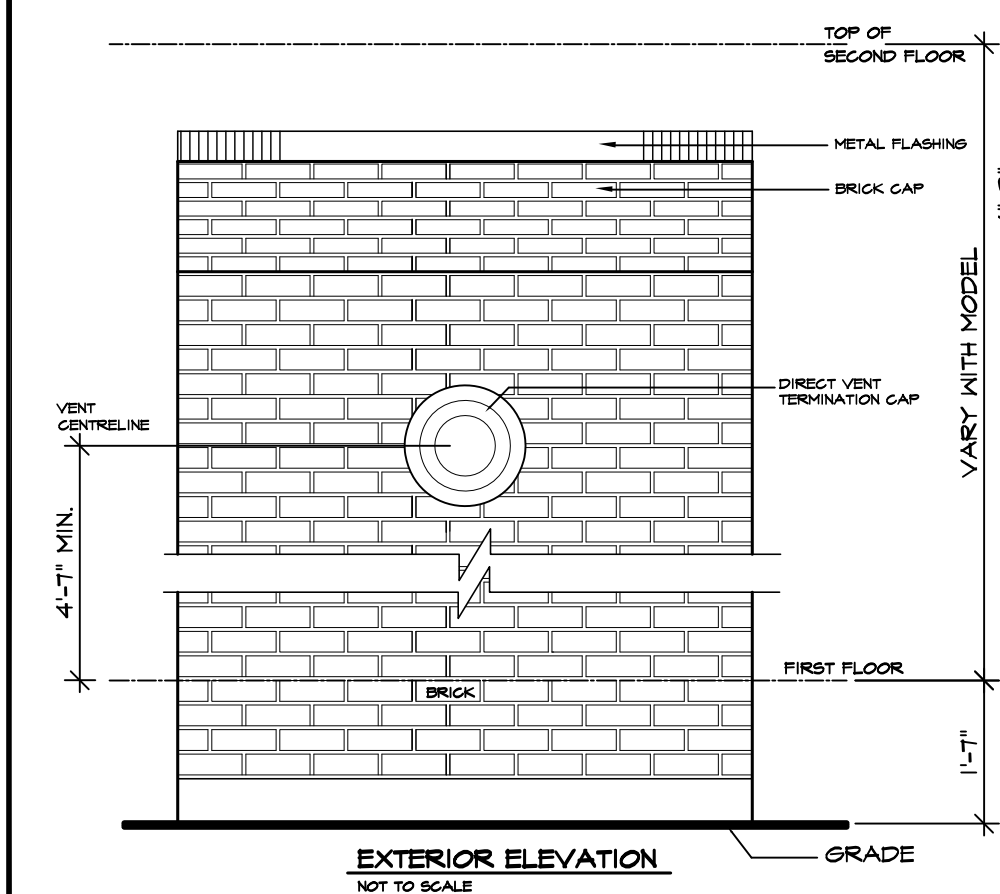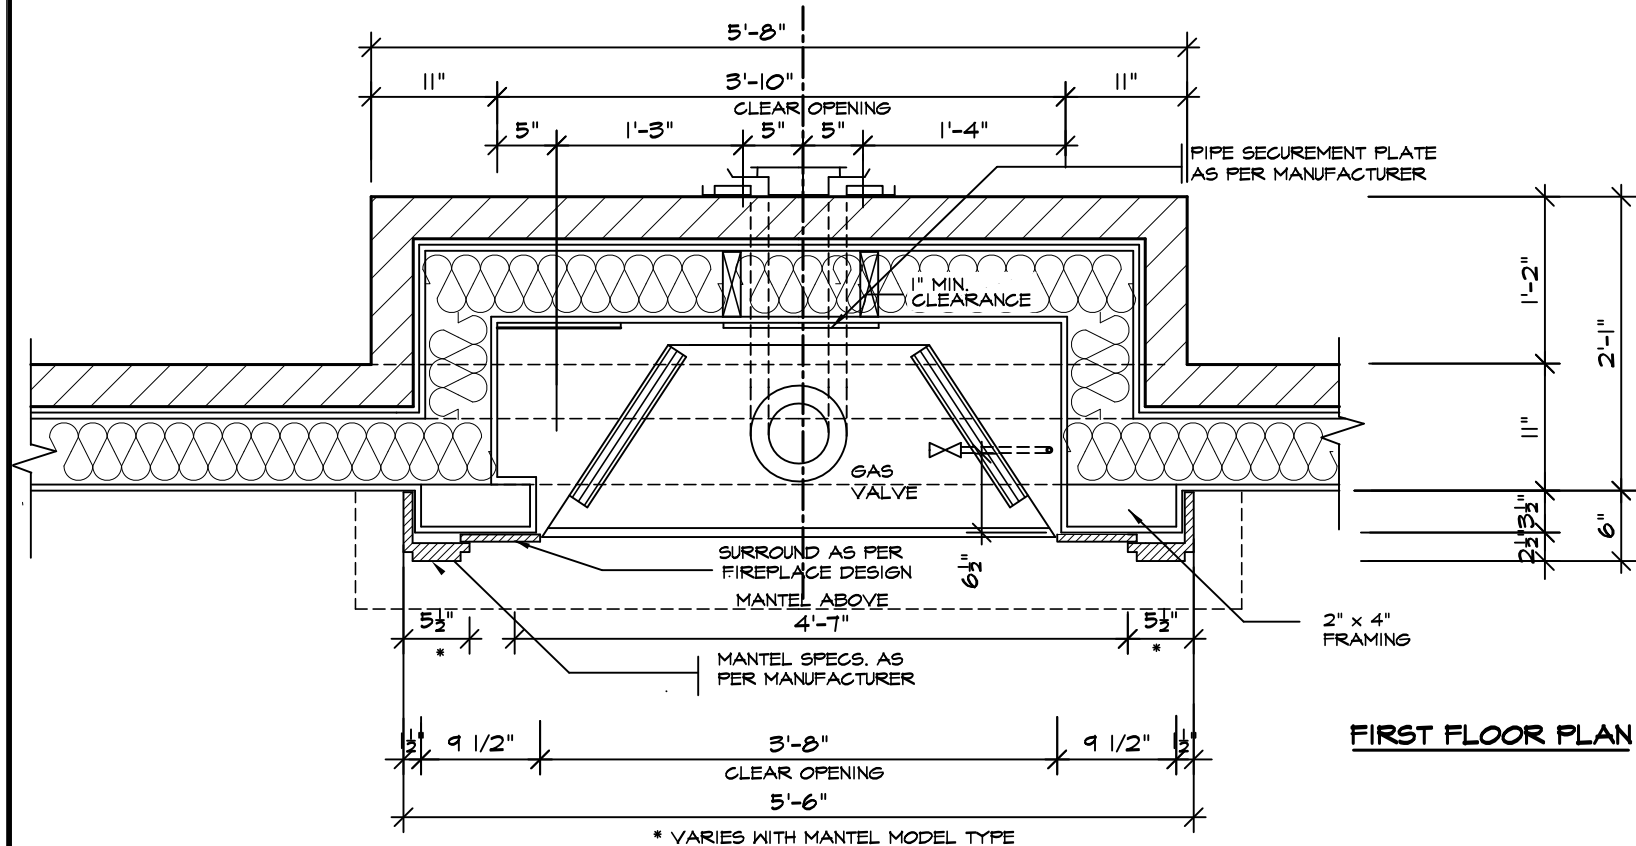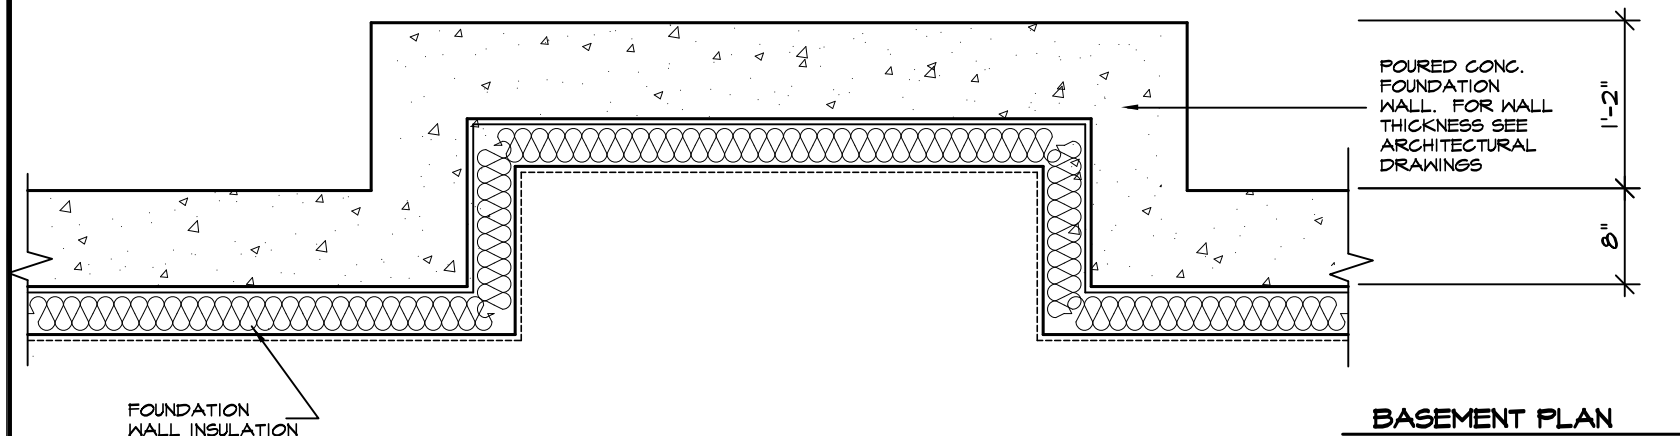


FRONT/SIDE ELEVATION

NOT TO SCALE

GENERAL INSTALLATION NOTES

- 1.0 UNIT INSTALLATION TO STRICTLY CONFORM TO MANUFACTURERS INSTALLATION MANUAL AND ALL APPLICABLE CODES OF LOCAL AUTHORITIES HAVING JURISDICTION INCLUDING CAN/CSA-B149.1 & 2.
- 2.0 INSTALL WITH THE FOLLOWING MINIMUM CLEARANCES TO COMBUSTIBLES:
 - FROM TOP OF UNIT 0"
 - FROM BACK OF UNIT 1/2"
 - FROM SIDES OF UNIT 1/2"
 - FROM TOP OF HORIZ. VENT 3"
 - FROM SIDES TO VENT 1"
- 3.0 THE DIRECT VENT UNIT ILLUSTRATED IS THE GC150 MODEL AS MANUFACTURED BY HEATILATOR.
- 4.0 THE MANTEL ILLUSTRATED IS THE S-2 GB AS SUPPLIED BY GREATER TORONTO FIREPLACE.

VARY REFERENCE TO MODEL

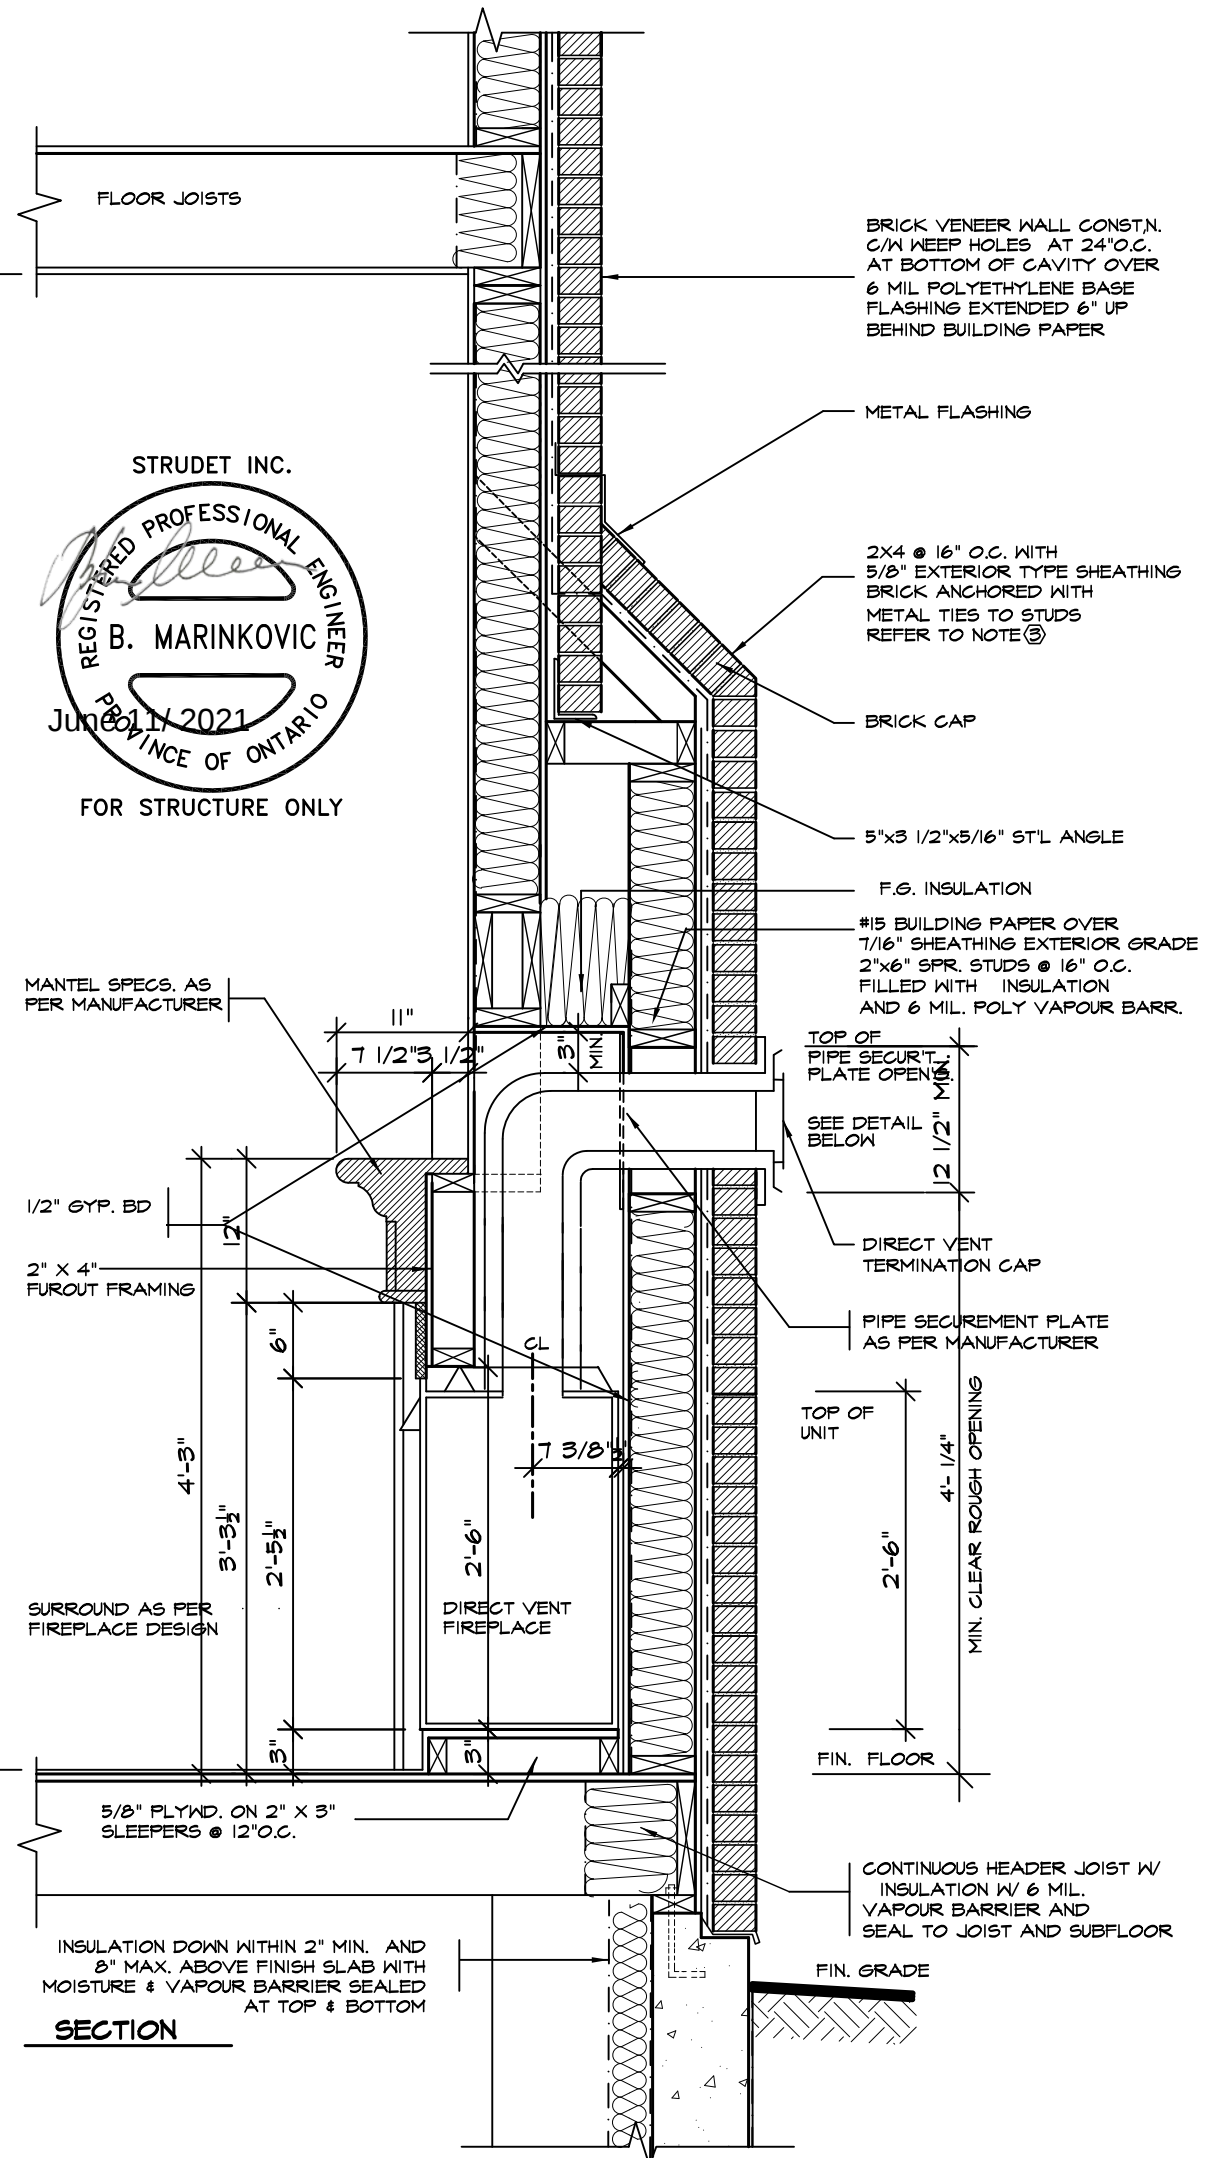

2012 CODE COMPLIANCE PACKAGE "A1"

5.		
4.		
3.		
2.		
1.	ISSUED FOR PERMIT	JUL 30, 2018
REVISIONS		

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION

Required unless design is exempt under Division C, Subsection 3.2.5 of the building code

VIKAS GAJJAR
NAME

28770
BCIN

SIGNATURE

REGION DESIGN INC.
8700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4S6
P (416) 736-4096
F (905) 660-0746

REGION DESIGN INC.

SHEET TITLE
VENT FIREPLACE DIRECT

SCALE
3/4"=1'-0"

DATE
JULY 2018

CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.




PAGE No.
7-2

Greenpark

PROJECT NAME
ROUNDEL

09/22/2022

RECEIVED
Per: joshua.nabua

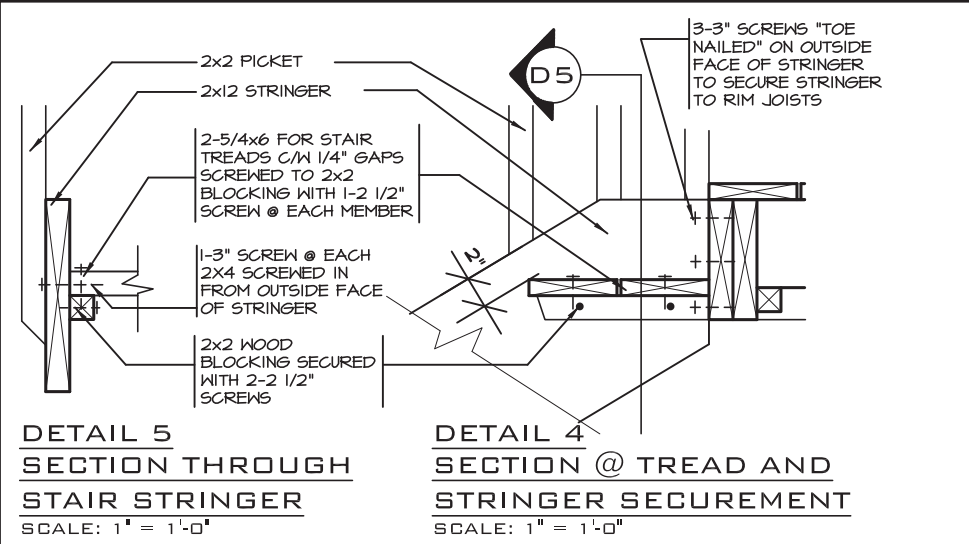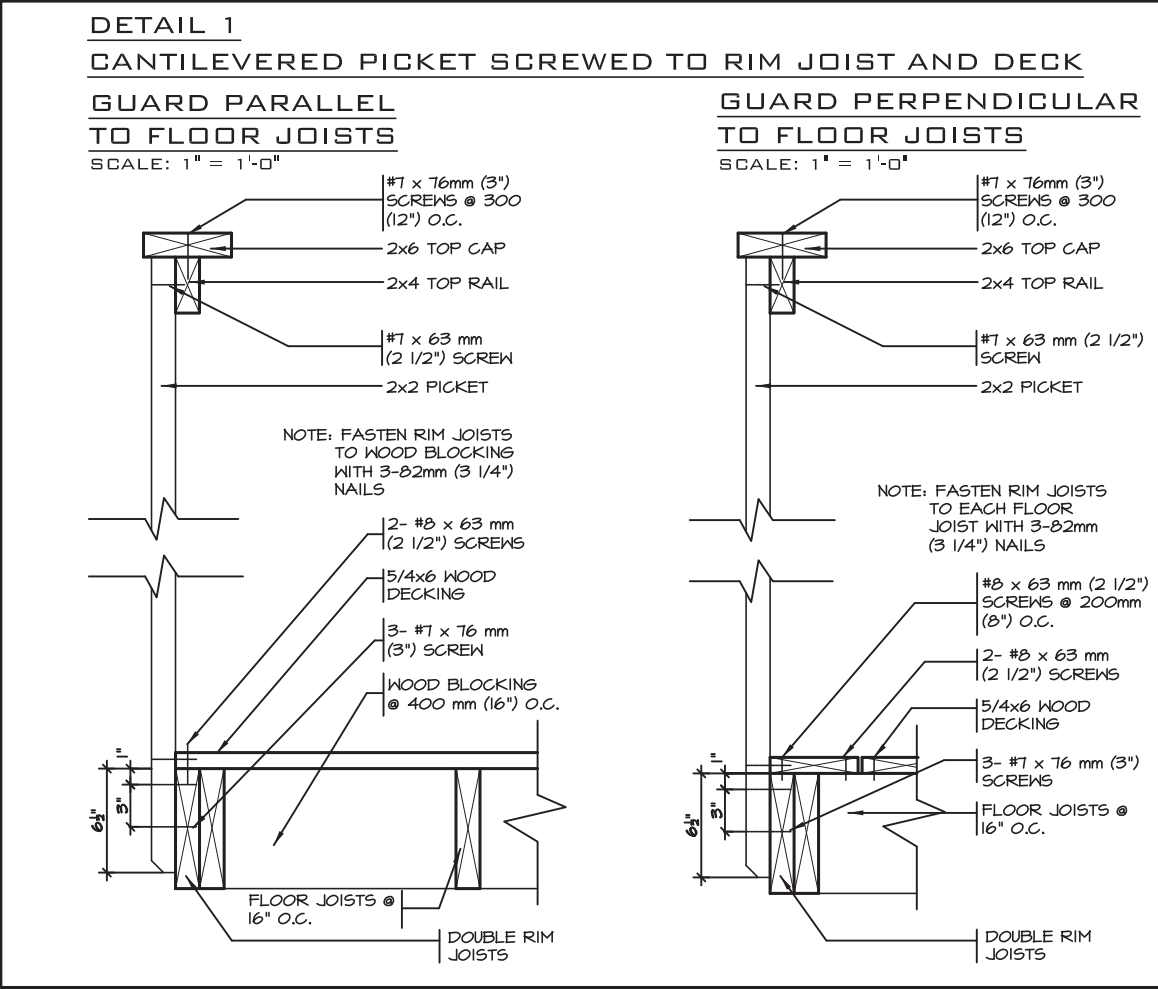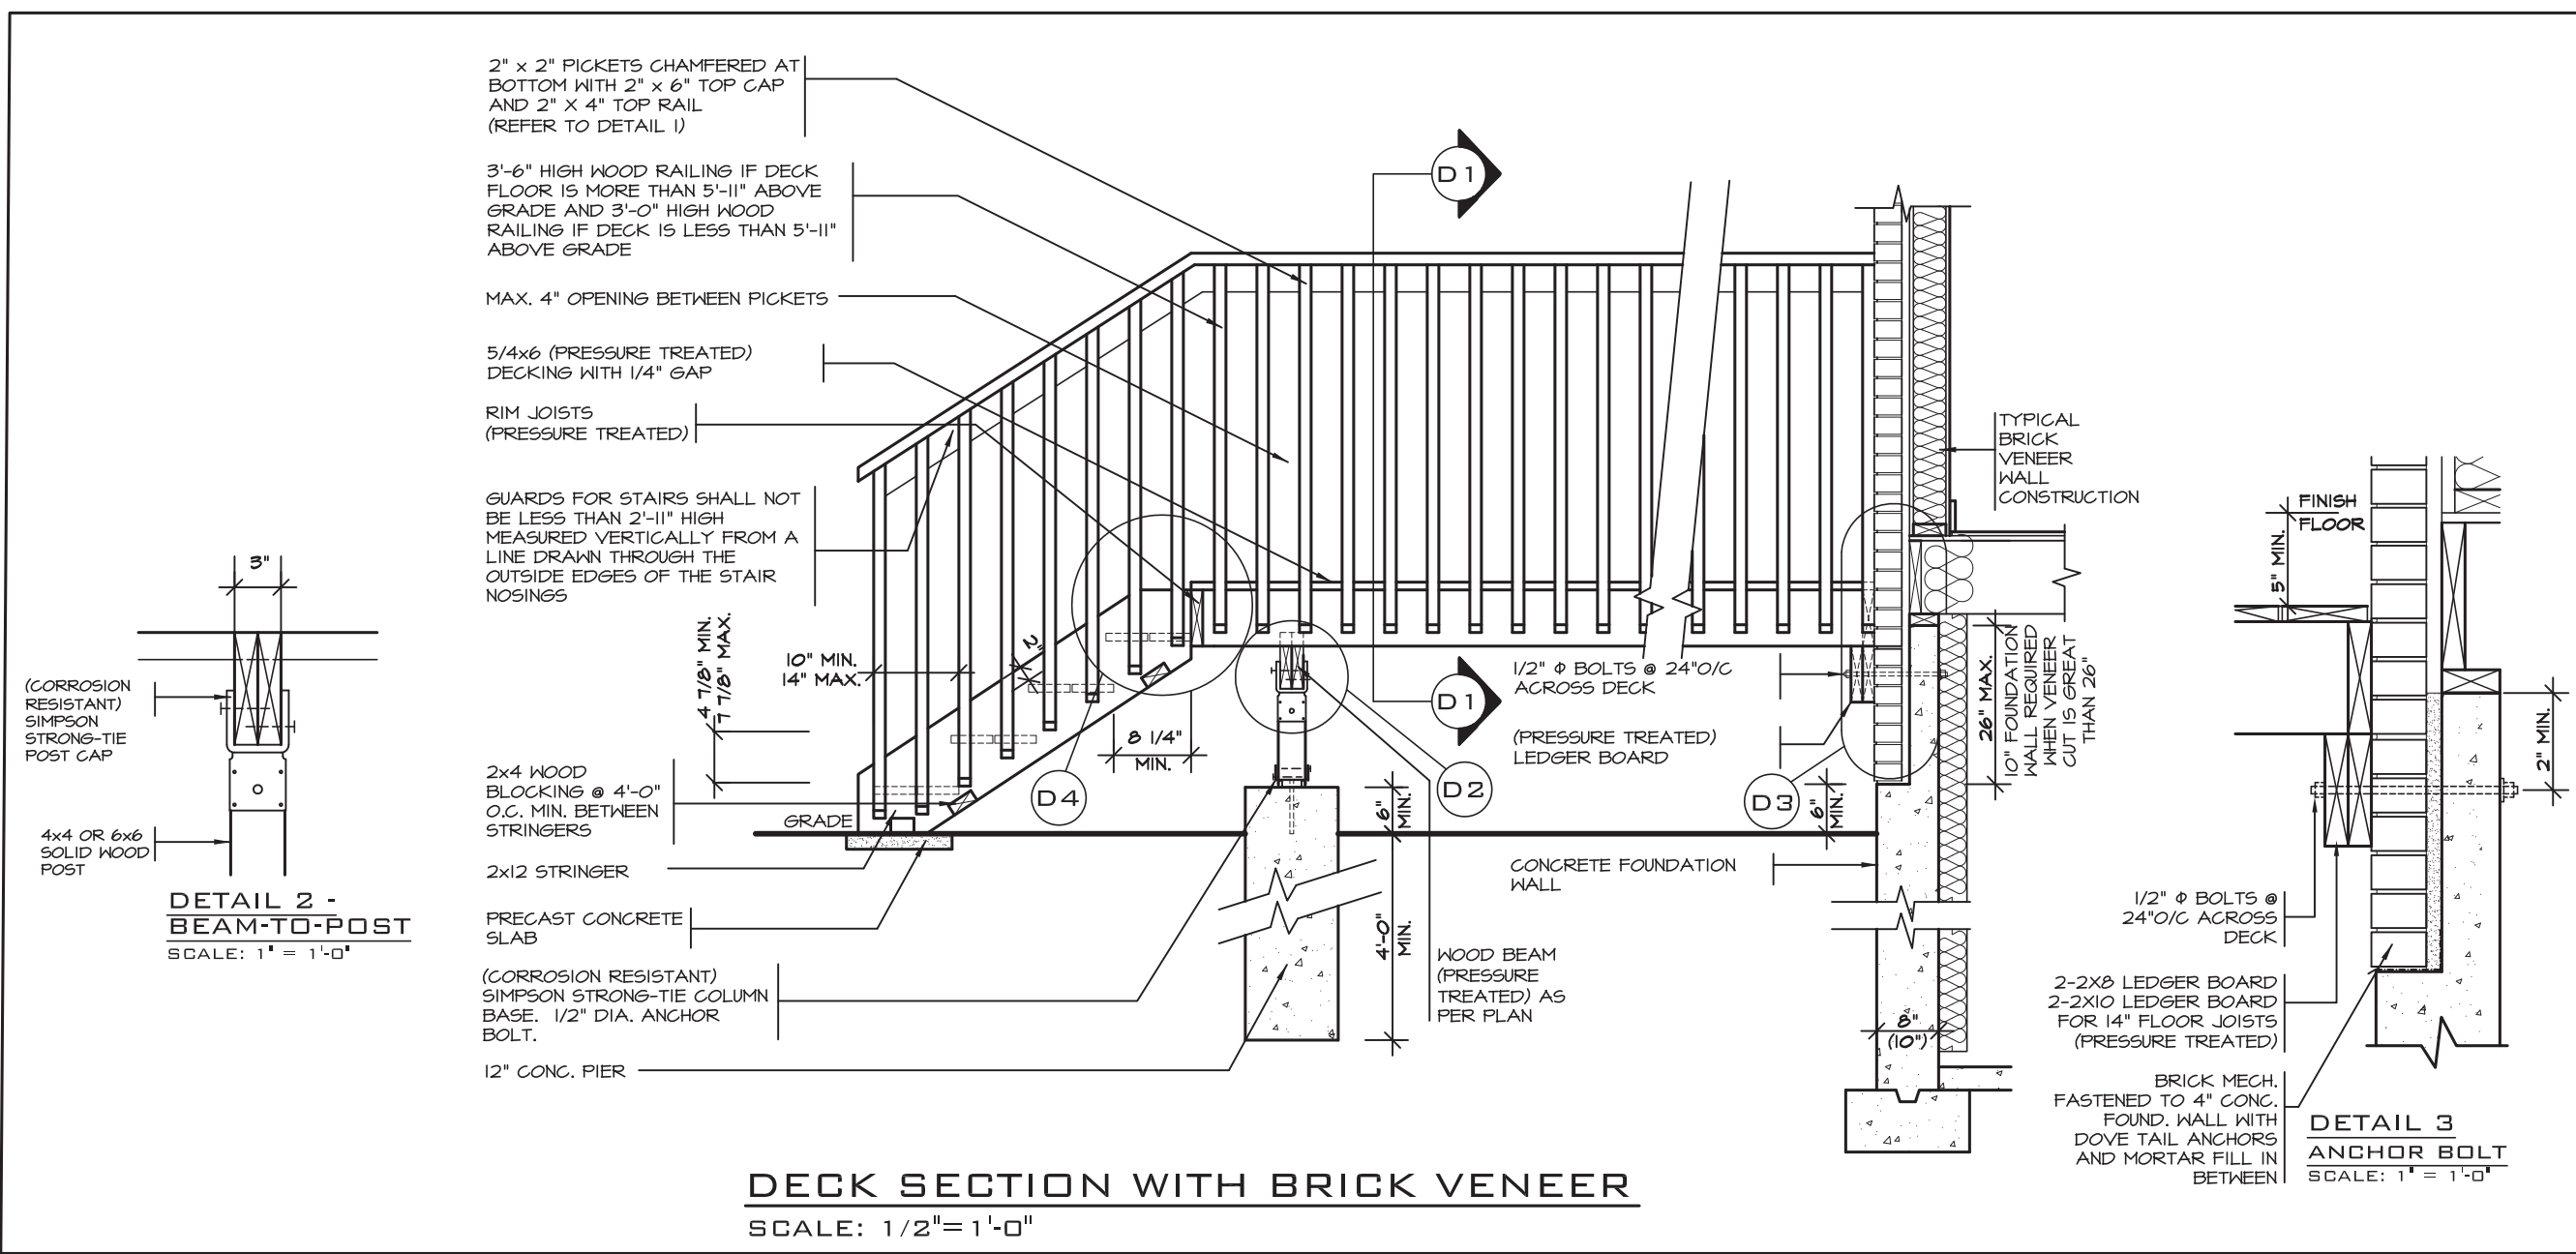

- GENERAL NOTES**
- BRICK TO BE COMPRESSIVE STRENGTH OF 15MPa (2200 p.s.i.) MIN. UNITS TO BE LAID WITH FULL HEAD AND BED JOINTS.
 - MORTAR TO BE TYPE S WITH JOINT THICKNESS OF 10mm (3/8") MIN. AND 20mm (3/4") MAX.
 - ALL NAILS AND SCREWS TO BE GALVANIZED.
 - WOOD FOR CANTILEVERED PICKETS PICKETS SHALL BE DOUGLAS FIR-LARCH, SPRUCE-PINE-FIR, OR HEM-FIR SPECIES.
 - THE DECK HAS BEEN DESIGNED TO SAFELY SUPPORT A SUPERIMPOSED LOAD OF 1.9kPa [40psf].
 - CONCRETE SHALL HAVE COMPRESSIVE STRENGTH OF 20MPa AT 28 DAYS AND 5-8% AIR ENTRAINED.
 - FOOTING TO BE PLACED ON UNDISTURBED SOIL WITH MIN. BEARING PRESSURE OF 150kPa [3130psf].

5.		
4.		
3.		
2.		
1.	ISSUED FOR PERMIT	JULY 30, 2018
REVISIONS		

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION
Required unless design is exempt under Division C, Subsection 3.2.5 of the building code

VIKAS GAJJAR
NAME
28770
BCIN

REGION DESIGN INC.
8700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4S6
P (416) 736-4096
F (905) 660-0746



SHEET TITLE
WOOD
DECK DETAIL

SCALE
AS SHOWN

DATE
JULY 2018

CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.

PAGE No.
8

Greenpark BUILDING DIVISION

PROJECT NAME
ROUNDEL


09/22/2022

RECEIVED
Per: joshua.nabua




FOR STRUCTURE ONLY
2012 CODE

COMPLIANCE PACKAGE "A1"

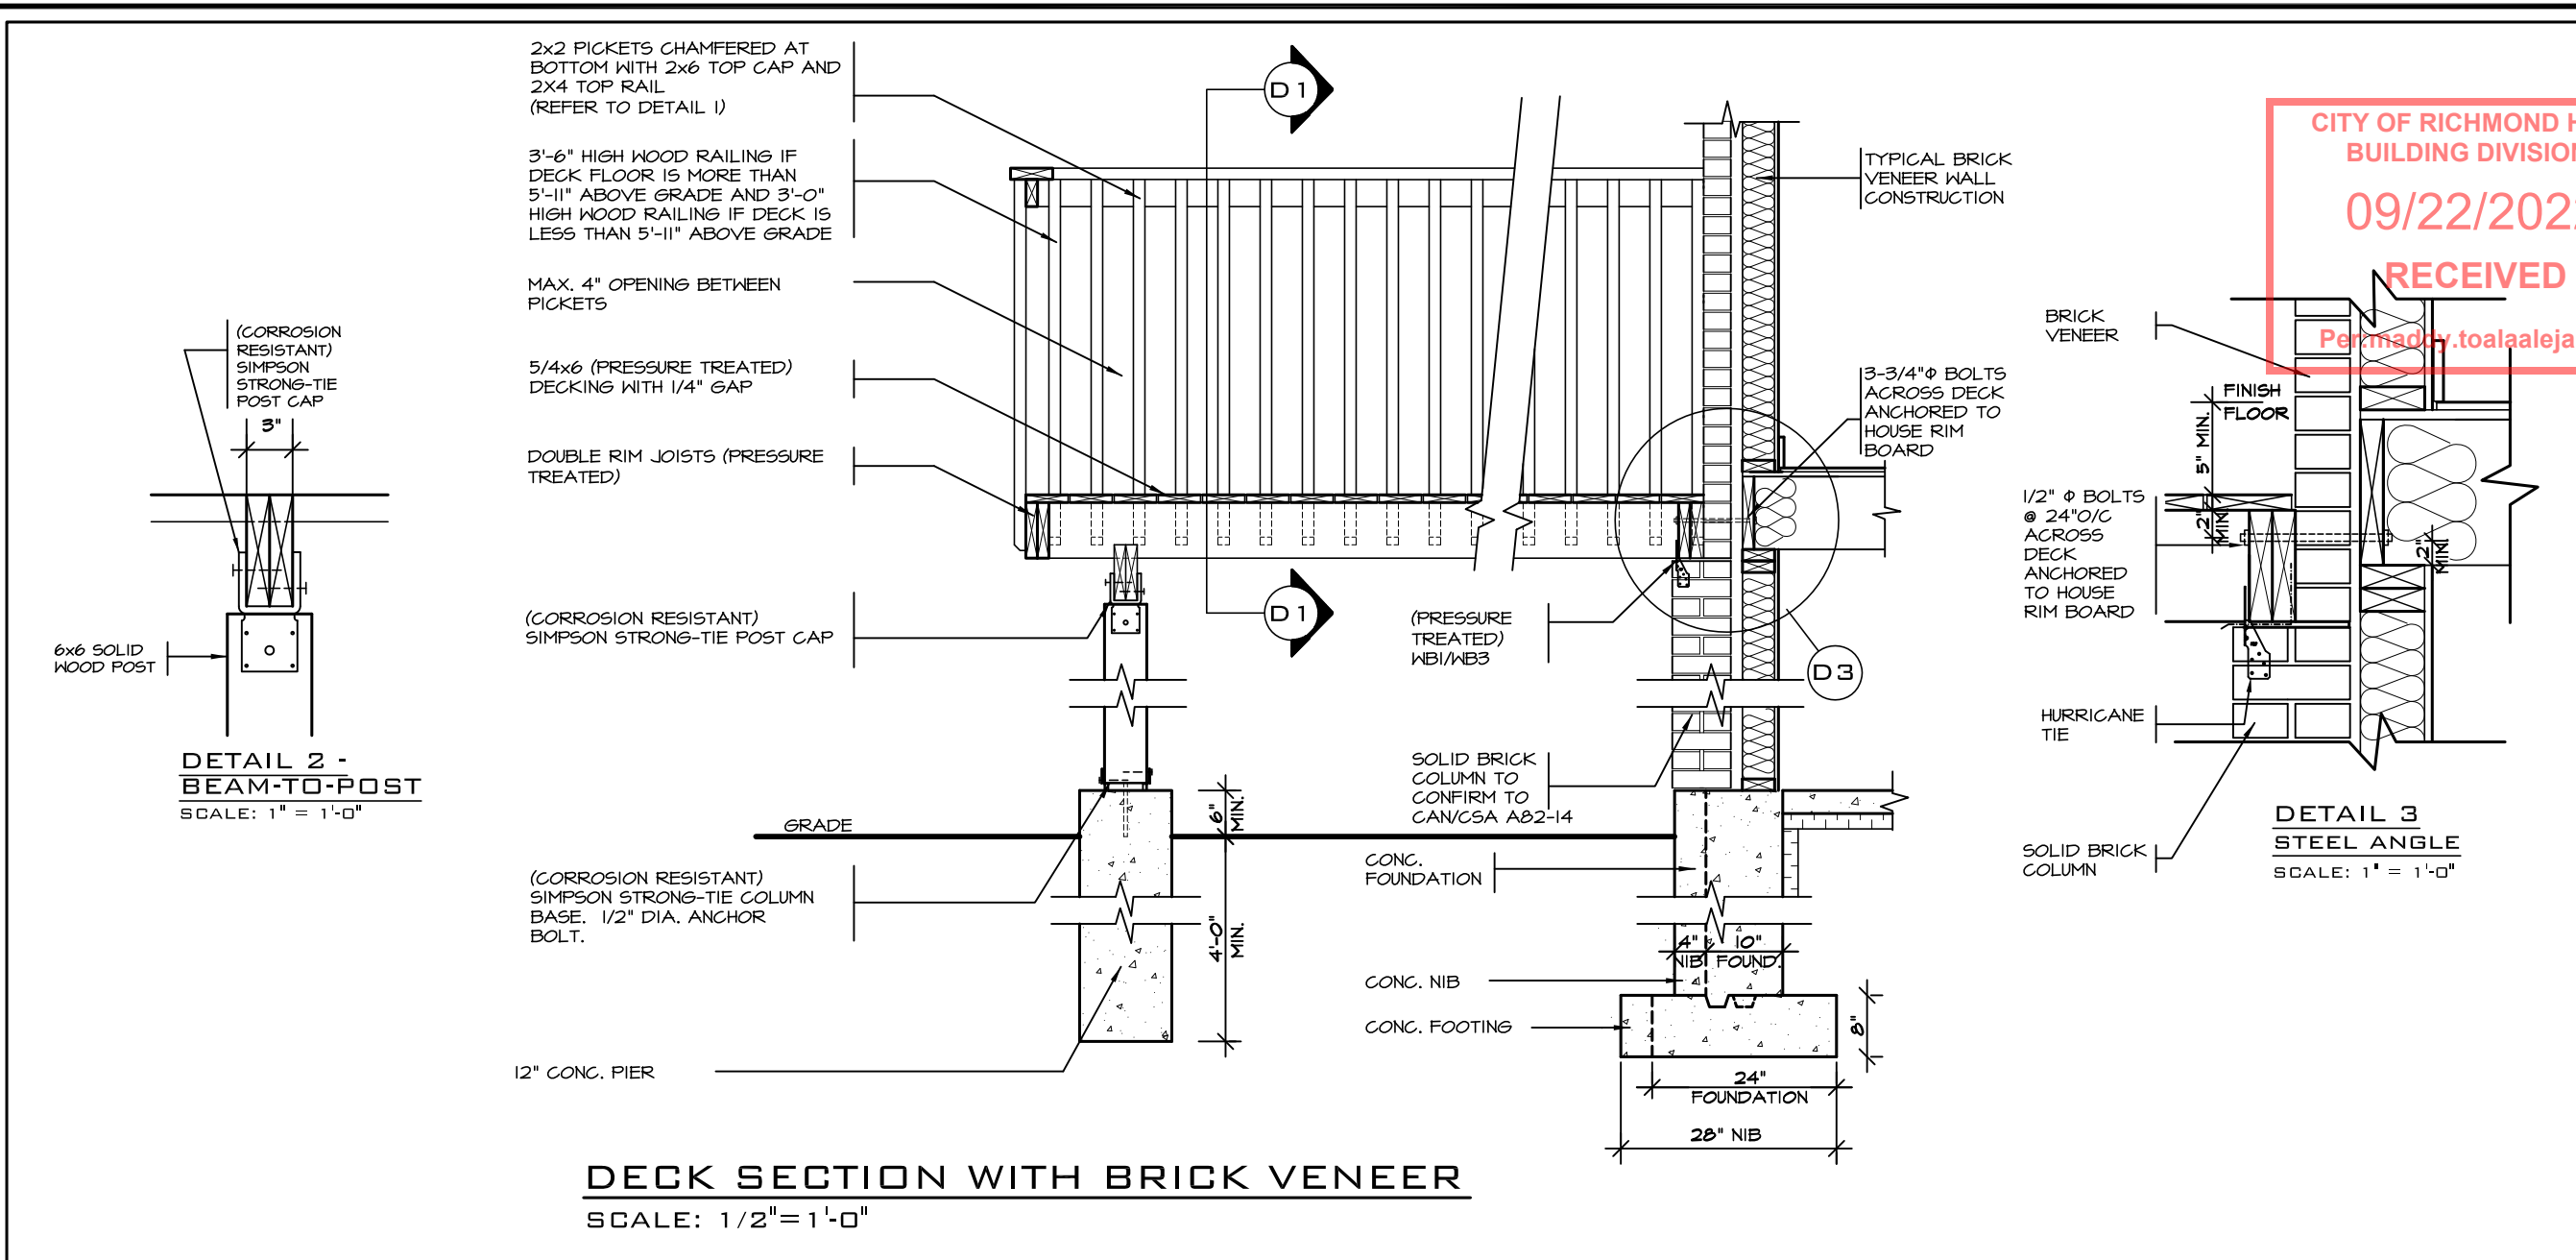

CITY OF RICHMOND HILL
BUILDING DIVISION
09/22/2022
RECEIVED
Permacon.toalaalejandro

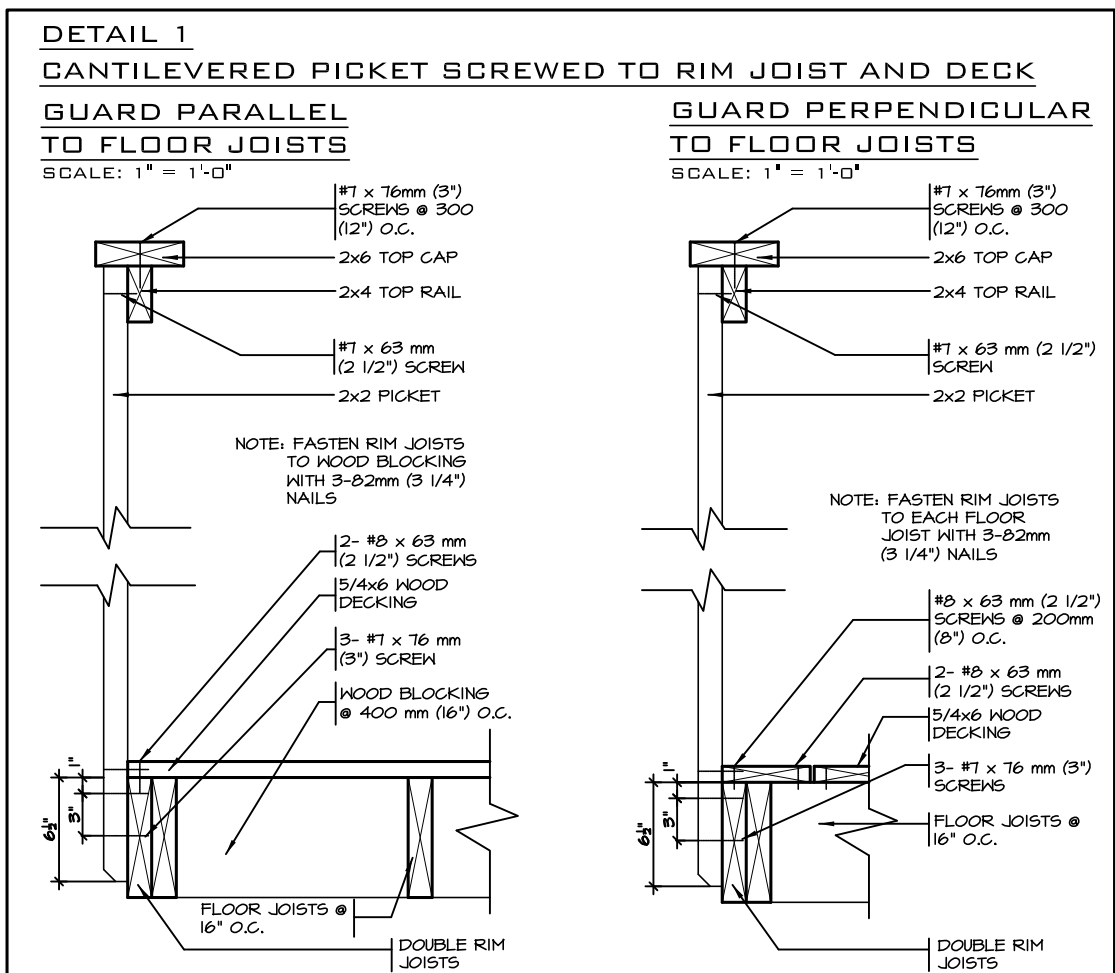

GENERAL NOTES

1. BRICK TO BE COMPRESSIVE STRENGTH OF 15MPa (2200 p.s.i.) MIN. UNITS TO BE LAID WITH FULL HEAD AND BED JOINTS.
2. MORTAR TO BE TYPE S WITH JOINT THICKNESS OF 10mm (3/8") MIN. AND 20mm (3/4") MAX.
3. ALL NAILS AND SCREWS TO BE GALVANIZED.
4. WOOD FOR CANTILEVERED PICKETS PICKETS SHALL BE DOUGLAS FIR-LARCH, SPRUCE-PINE-FIR, OR HEM-FIR SPECIES.
5. THE DECK HAS BEEN DESIGNED TO SAFELY SUPPORT A SUPERIMPOSED LOAD OF 1.9kPa [40psf].
6. CONCRETE SHALL HAVE COMPRESSIVE STRENGTH OF 20MPa AT 28 DAYS AND 5-8% AIR ENTRAINED.
7. FOOTING TO BE PLACED ON UNDISTURBED SOIL WITH MIN. BEARING PRESSURE OF 150kPa [3130psf].



2012 CODE
COMPLIANCE PACKAGE "A1"

5.		
4.		
3.		
2.		
1.	ISSUED FOR PERMIT	JULY 30, 2018
REVISIONS		

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION
Required unless design is exempt under Division C, Subsection 3.2.5 of the building code

VIKAS GAJJAR
NAME
28770
BCIN

REGION DESIGN INC.
8700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4S6
P (416) 736-4096
F (905) 660-0746

REGION DESIGN INC.

SHEET TITLE
WALK-OUT DECK DETAILS

SCALE
AS SHOWN


DATE
JULY 2018

CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.


PAGE No.
8-2

Greenpark.

PROJECT NAME
ROUNDEL

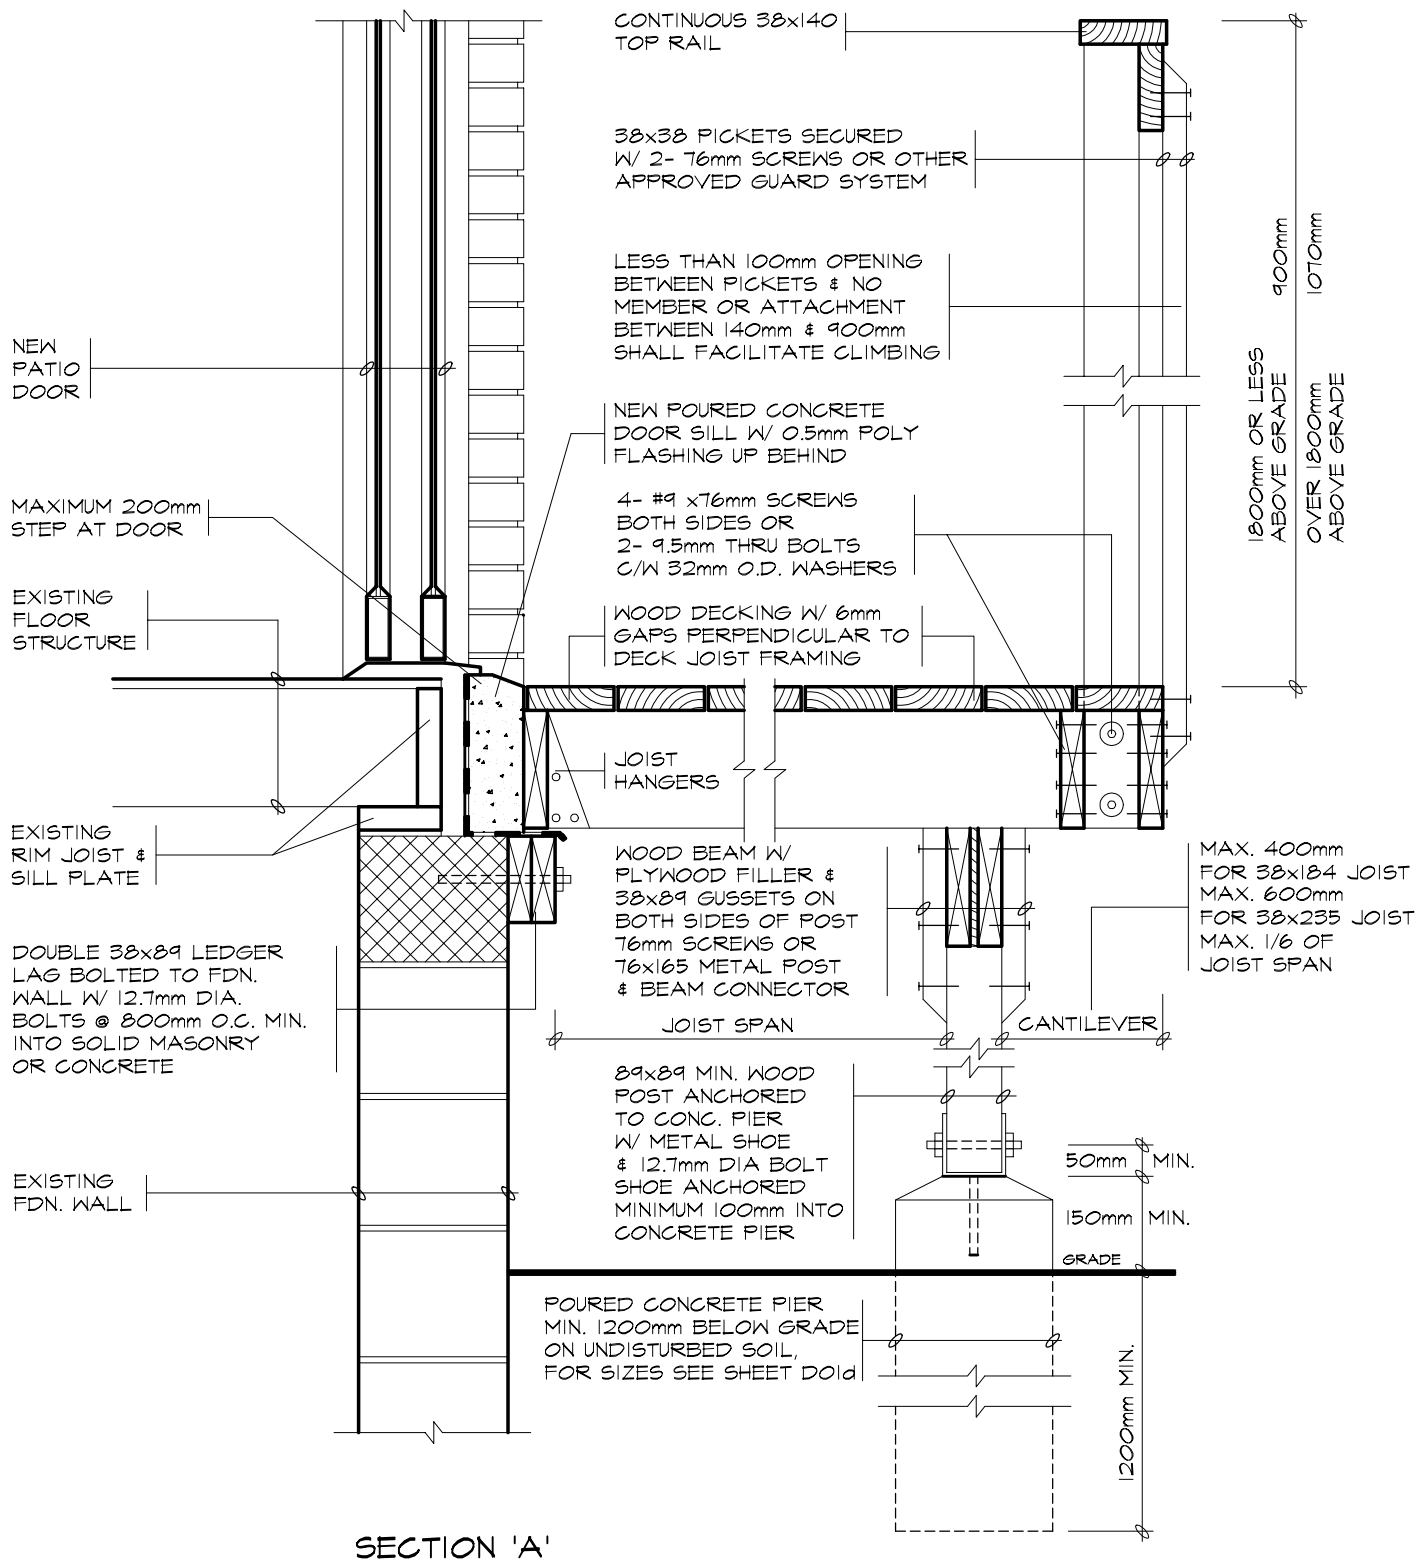

SECTION 'A'

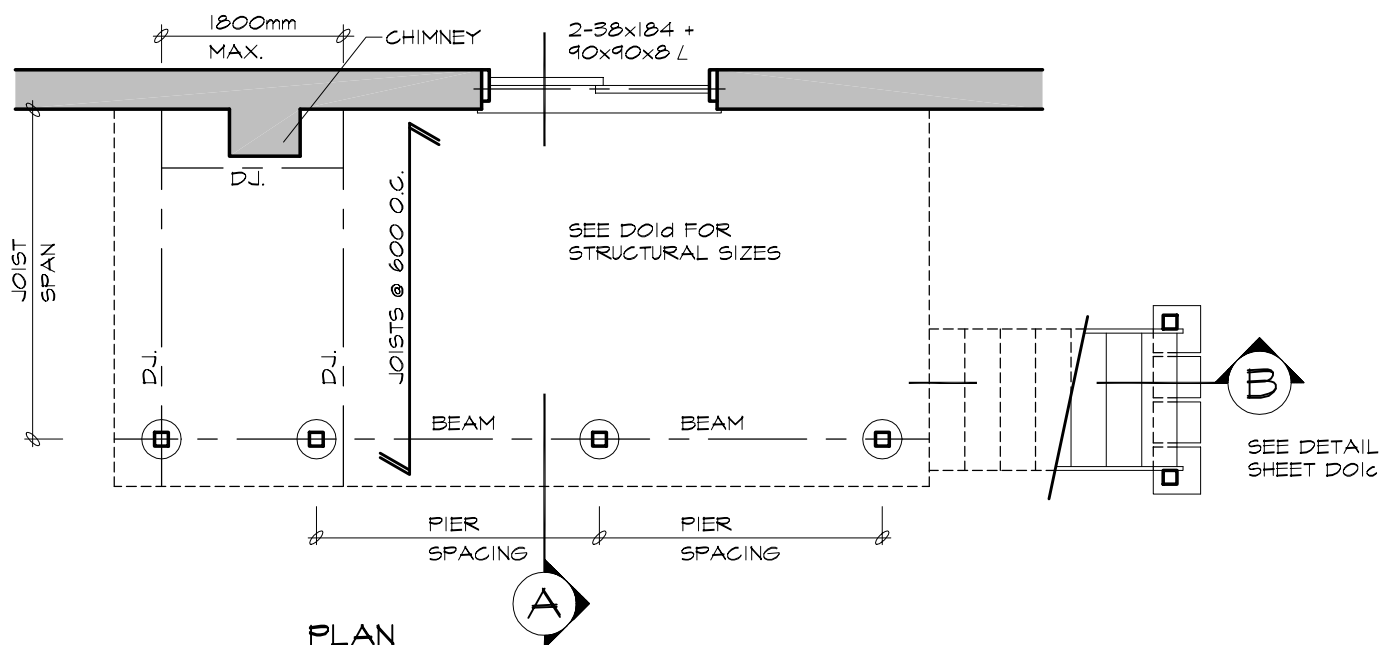

PLAN

**LMCBO
STANDARD
DETAILS**


TITLE **WOOD DECK** FIXED TO SOLID MASONRY FOUNDATION WALL
PLAN & SECTION

NOTE: UNDER THE BUILDING CODE ACT, THE LOCAL MUNICIPALITY IS THE AUTHORITY HAVING JURISDICTION FOR ENFORCING THE ACT AND ITS REGULATIONS. IT IS THE RESPONSIBILITY OF THE OWNER/DESIGNER TO ENSURE THAT ALL DESIGNS SUBMITTED FOR A PERMIT ARE IN ACCORDANCE WITH THE BUILDING CODE ACT, BUILDING CODE AND ANY OTHER APPLICABLE LAW.


DWG. NO.

D01a


2012

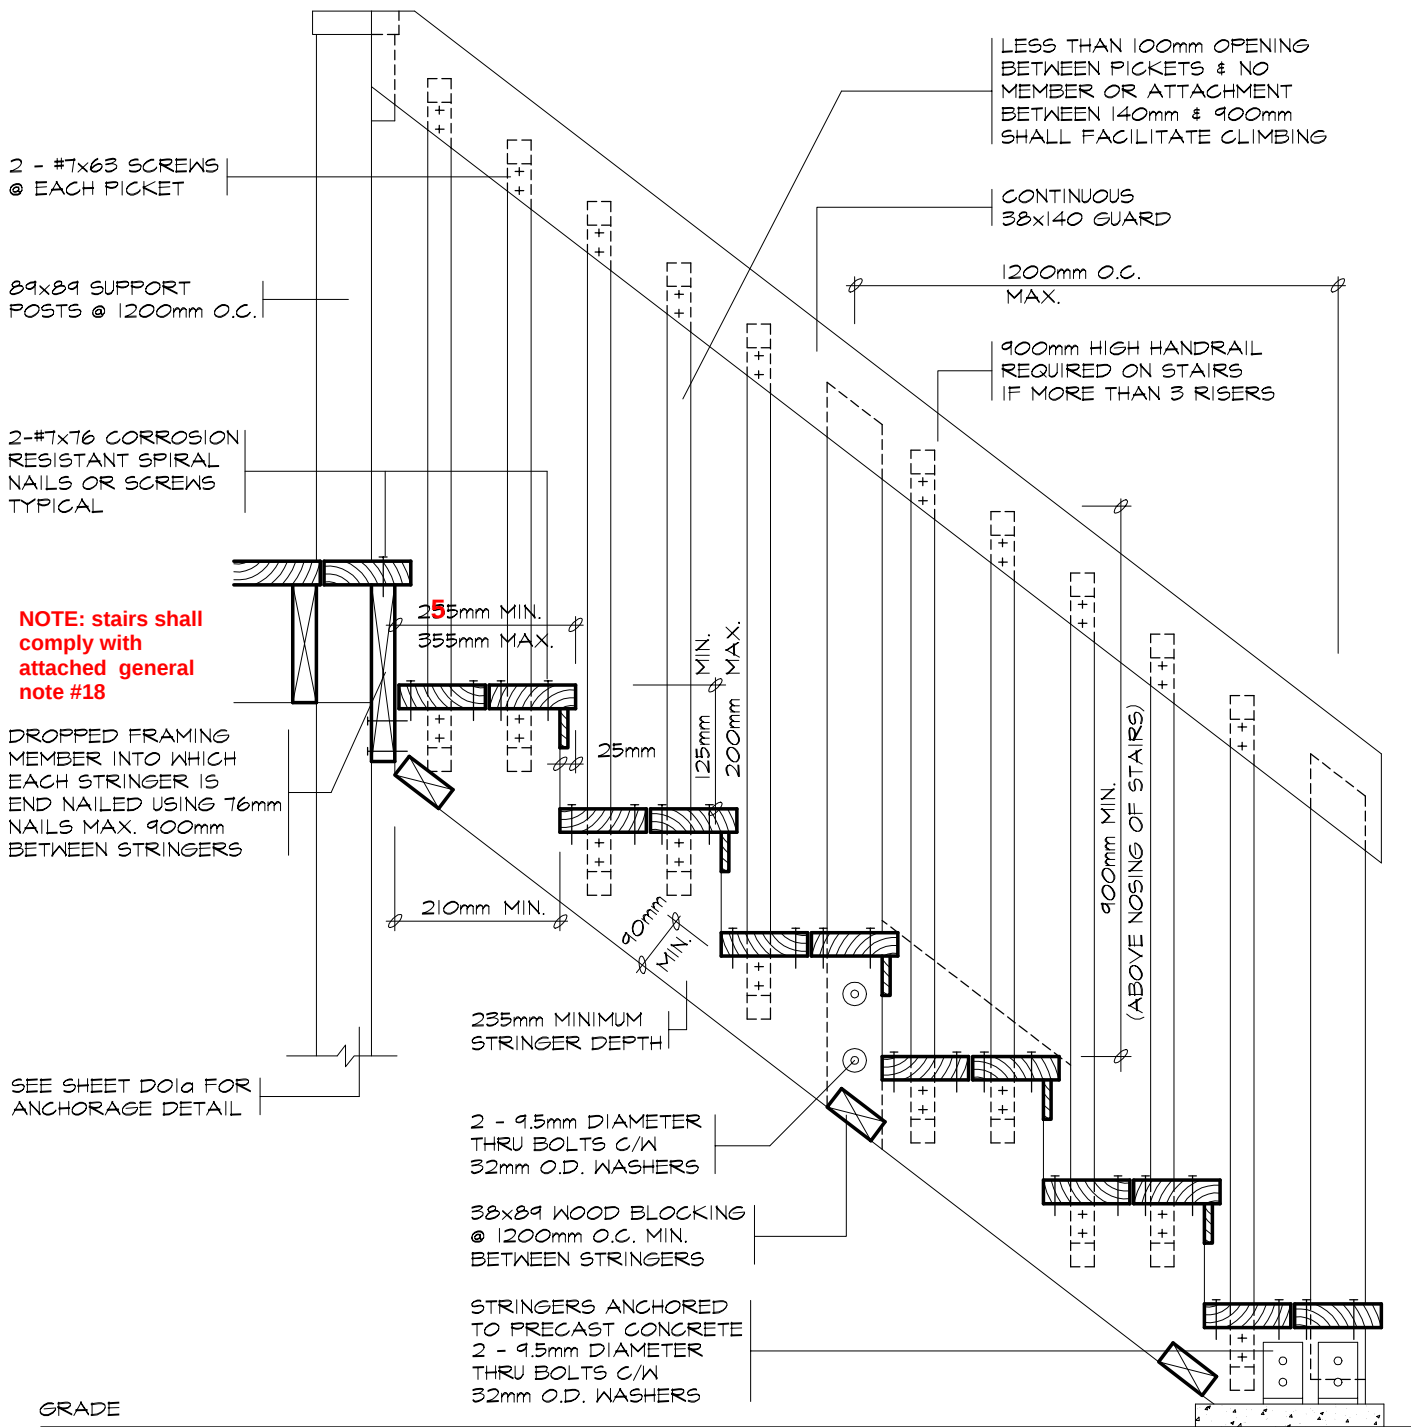

SECTION 'B'

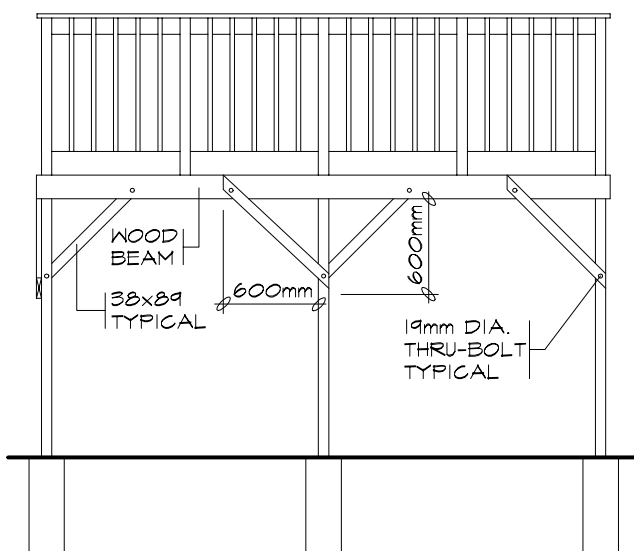

BRACING PARALLEL TO BEAM

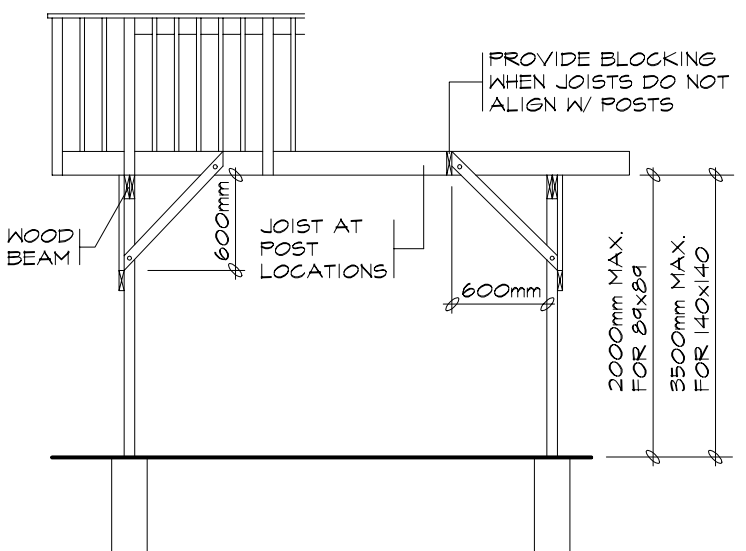

BRACING PERPENDICULAR TO BEAM

FREE STANDING DECKS GREATER THAN 600mm ABOVE GRADE SHALL RESIST LATERAL LOADING & MOVEMENT. ALL POSTS MUST BE BRACED WHERE THE SUPPORTED AREA EXCEEDS THOSE LISTED IN THE TABLE ON D01d

**LMCBO
STANDARD
DETAILS**

TITLE **WOOD DECK**

STAIR SECTION
LATERAL SUPPORT FOR FREE STANDING DECKS

DWG. NO.

D01c

NOTE: UNDER THE BUILDING CODE ACT, THE LOCAL MUNICIPALITY IS THE AUTHORITY HAVING JURISDICTION FOR ENFORCING THE ACT AND ITS REGULATIONS. IT IS THE RESPONSIBILITY OF THE OWNER/DESIGNER TO ENSURE THAT ALL DESIGNS SUBMITTED FOR A PERMIT ARE IN ACCORDANCE WITH THE BUILDING CODE ACT, BUILDING CODE AND ANY OTHER APPLICABLE LAW.

2012

BEAM SIZING TABLE									
SUPPORTED JOIST LENGTH (mm)	LIVE LOAD 1.9 kPa			LIVE LOAD 2.5 kPa			LIVE LOAD 3.0 kPa		
	PIER SPACING (mm)			PIER SPACING (mm)			PIER SPACING (mm)		
	2000	3000	4000	2000	3000	4000	2000	3000	4000
1500	2/38x140	2/38x184	3/38x235	2/38x140	3/38x184	3/38x235	3/38x140	2/38x235	2/38x286
2000	2/38x140	3/38x184	3/38x235	2/38x184	2/38x235	3/38x286	2/38x184	2/38x235	3/38x286
2500	2/38x184	2/38x235	3/38x286	2/38x184	3/38x235	3/38x286	2/38x184	3/38x235	4/38x286
3000	2/38x184	2/38x235	3/38x286	2/38x184	3/38x235	4/38x286	2/38x184	3/38x235	4/38x286
3500	2/38x184	3/38x235	3/38x286	2/38x184	3/38x235	4/38x286	3/38x184	3/38x286	N/A
4000	2/38x184	3/38x235	4/38x286	2/38x184	3/38x286	N/A	3/38x184	3/38x286	N/A


JOIST SIZING TABLE									
JOIST SPAN (mm)	LIVE LOAD 1.9 kPa			LIVE LOAD 2.5 kPa			LIVE LOAD 3.0 kPa		
	JOIST SPACING (mm)			JOIST SPACING (mm)			JOIST SPACING (mm)		
	305	406	610	305	406	610	305	406	610
2000	38x140	38x140	38x140	38x140	38x140	38x140	38x140	38x140	38x140
2500	38x140	38x140	38x184	38x140	38x140	38x184	38x140	38x184	38x184
3000	38x140	38x184	38x184	38x184	38x184	38x235	38x184	38x184	38x235
3500	38x184	38x184	38x235	38x184	38x235	38x235	38x235	38x235	38x235
4000	38x235	38x235	38x286	38x235	38x235	38x286	38x235	38x235	38x286

FOOTING SIZES	
SOIL BEARING CAPACITIES (kPa)	
SOIL TYPE	BEARING PRESSURE (kPa)
SOFT CLAY	40
LOOSE SAND OR GRAVEL	50
FIRM CLAY	75
DENSE OR COMPACT SILT	100
STIFF CLAY	150
DENSE COMPACT SAND OR GRAVEL	150
TILL	200
CLAY SHALE	300
SOUND ROCK	500

PIER SIZES	
DIAMETER (mm)	M ²
200	0.03
250	0.05
300	0.08
350	0.10
400	0.13
500	0.20
600	0.30

POST SIZING TABLE				
POST SIZE (mm)	MAXIMUM HEIGHT (M)	MAX. SUPPORTED DECK AREA (M2)		
		LIVE LOAD (kPa)		
		1.9	2.5	3.0
89x89	1.0	10.86	8.71	7.48
	1.5	5.93	4.76	4.09
	2.0	3.15	2.53	2.17
140x140	2.0	13.67	10.98	9.43
	2.5	9.32	7.48	6.43
	3.0	6.35	5.10	4.38
	3.5	4.41	3.54	3.04

EXAMPLE PLAN	PIERS	SUPPORTED DECK AREA
	P1	2 x 1.7 = 3.4m ²
	P2	2 x 2.6 = 5.2m ²
	P3	2 x 1.7 = 3.4m ²
	P4	1.4 x 1.7 = 2.4m ²
	P5	1.4 x 2.6 = 3.6m ²
	P6	1.4 x 1.7 = 2.4m ²
	BEAMS	SUPPORTED JOIST LENGTH
	B1	2000mm
	B2	2000mm
	B3	1400mm
	B4	1400mm
	BEAM SPAN = 2600mm	
	JOIST SPAN = 2000mm	

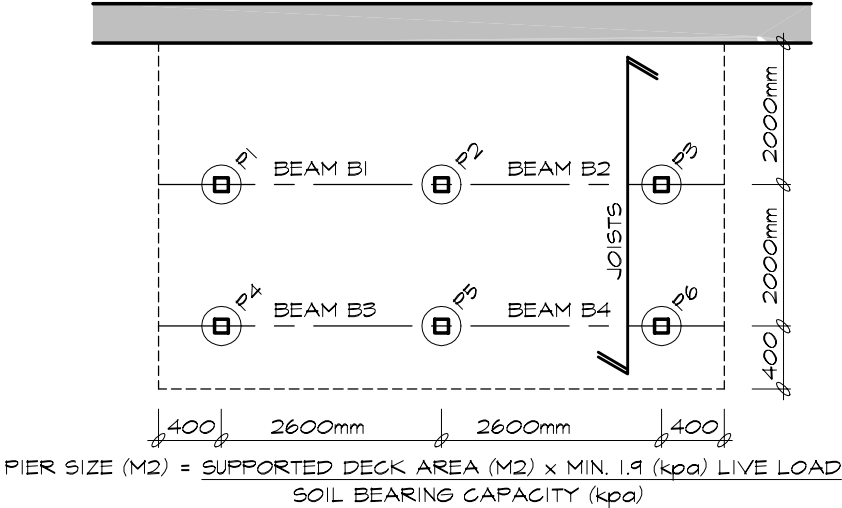

GENERAL NOTES

1. A MINIMUM LIVE LOAD OF 1.9 (kPa) SHALL BE APPLIED IN ALL LOCATIONS.

2. THE PRESCRIBED SNOW LOAD FOR 225 SELECTED ONTARIO LOCATIONS IS INDICATED IN COLUMN I2 OF TABLE I.2 IN SUPPLEMENTARY GUIDELINE SB-1 OF THE ONTARIO BUILDING CODE. THE SNOW LOAD SHALL BE APPLIED AS THE MINIMUM LIVE LOAD WHERE IT IS GREATER THAN 1.9 (kPa)

3. A SITE PLAN OR SURVEY IS REQUIRED SHOWING ALL LOT LINES & DIMENSIONS, SIZE & LOCATION OF ALL EXISTING BUILDINGS & DECKS.

4. LUMBER NO. 2 SPF OR BETTER WOOD POSTS MIN. 89x89 (SOLID). USE CORROSION RESISTANT SPIRAL NAILS OR SCREWS.

5. A DECK IS NOT PERMITTED TO BE SUPPORTED ON BRICK VENEER.

6. CANTILEVERED JOISTS AND BEAMS ARE LIMITED TO 1/6 THE MEMBERS LENGTH.
7. CONCRETE PIERS SHALL BEAR ON UNDISTURBED SOIL. THE BEARING CAPACITY OF THE SOIL SHALL BE DETERMINED PRIOR TO CONSTRUCTION.

8. MAXIMUM HEIGHT REFERS TO THE HEIGHT OF THE POST FROM THE TOP OF THE PIER TO THE DECK SURFACE.

9. BEAMS WITH MORE THAN 2 MEMBERS MUST BE SUPPORTED BY 140x140 POSTS.

10. THE ALLOWABLE SOIL BEARING PRESSURE SHALL BE REDUCED BY 50% WHILE THE WATER IS AT OR NEAR THE BOTTOM OF THE FOOTING EXCAVATION.

11. CONTACT YOUR LOCAL BUILDING DEPARTMENT FOR FURTHER INFORMATION ABOUT LOCAL SOIL BEARING CAPACITIES.

12. JOISTS SPANNING MORE THAN 2100mm ARE TO HAVE BRIDGING AT LEAST EVERY 2100mm O.C..

SB-7 Guards for Housing and Small Buildings

2.1. Materials

2.1.1. Lumber Grades

- (1) The minimum grade of softwood dimension lumber for posts, rails and joists shall be Northern Species, No. 2.
- (2) The minimum grade of softwood dimension lumber for pickets shall be Northern Species, No. 2 Picket grade.
- (3) Wood for pickets shall be free of loose knots.
(See Appendix A.)


SB-7 Page 1

Table 2.1.2
Minimum Size of Loadbearing Elements


Guard Element	Minimum Size, mm (in)
Post	89 x 89 (4" x 4" nominal)
Top Rail	38 x 89 (2" x 4" nominal)
Bottom Rail	38 x 89 (2" x 4" nominal)
Picket / Baluster	32 x 32 (1 ⁵ / ₃₂ " x 1 ⁵ / ₃₂ " nominal)
Column 1	2

Table 2.1.3
Minimum Size of Floor Elements


Floor Element	Minimum size, mm (in)
Dimension Lumber Decking	25 x 140 (1" x 6" nominal), when each plank is fastened with 2 - 63 mm (2 ¹ / ₂ ") nails
	38 x 89 (2" x 4" nominal), when each plank is fastened with 2 - 76 mm (3") nails
Dimension Lumber Joists	38 x 184 (2" x 8" nominal)
Column 1	2




PLAN

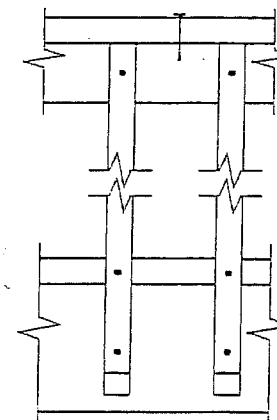

FRONT ELEVATION

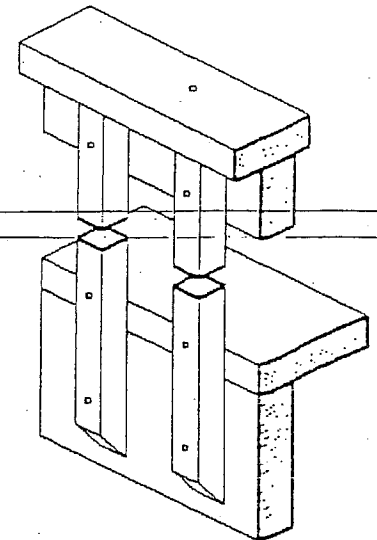

AXONOMETRIC

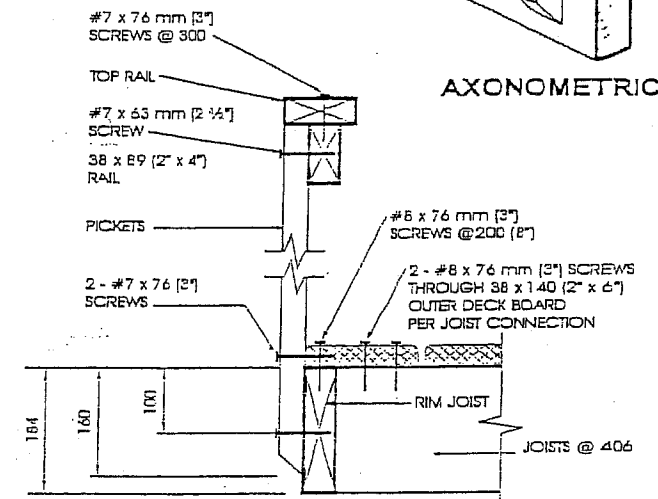


SIDE ELEVATION

Detail ED-3

Exterior Connection: Cantilevered Picket Screwed to Rim Joist and Deck

Notes:

1. Provide a suitable post, return, or solid support at each end of the guard.
2. Wood for cantilevered pickets shall be Northern Species.
3. Fasten rim joist to each floor joist with 3 - 82 mm (3¹/₂") nails.
4. Dimensions shown are in mm unless otherwise specified.

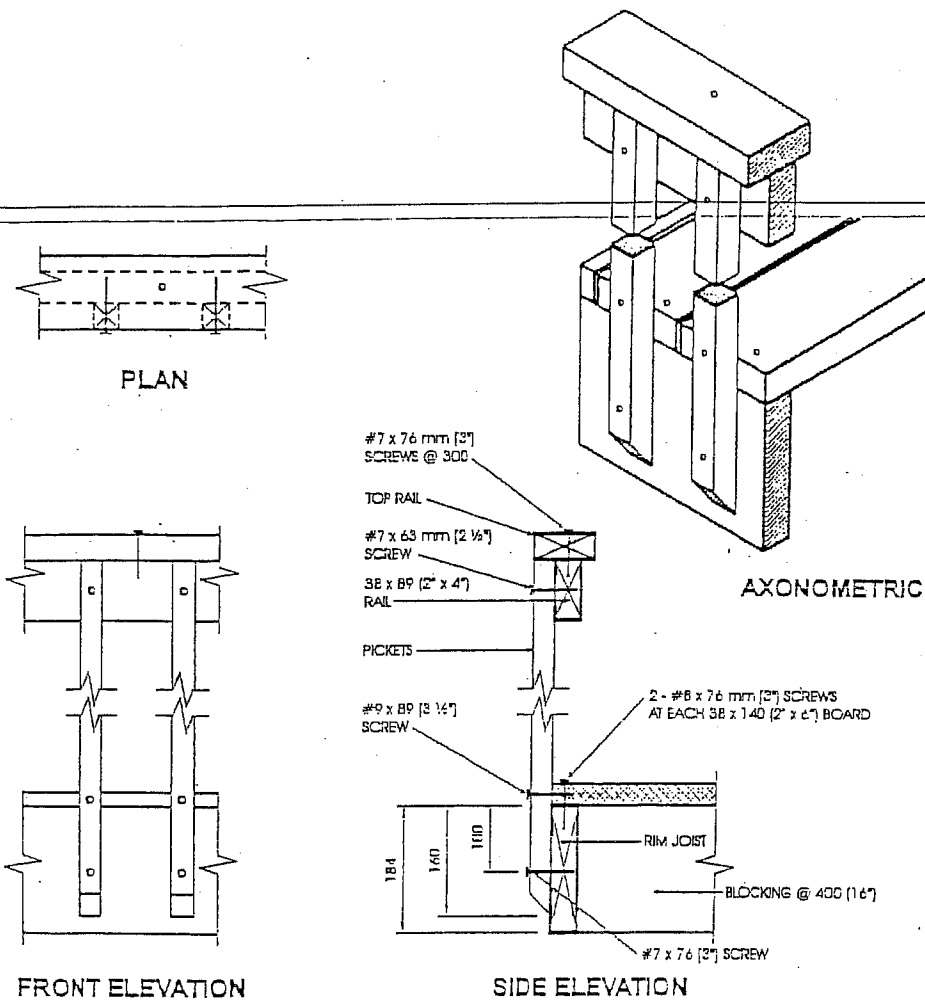


Detail ED-4

Exterior Connection: Cantilevered Picket Screwed to Rim Joist and Deck,
Guard Parallel to Floor Joists

Notes:

1. Provide a suitable post, return, or solid support at each end of the guard.
2. Wood for cantilevered pickets shall be Northern Species.
3. Fasten rim joist to blocking with 3 - 82 mm (3 1/4") nails.
4. Dimensions shown are in mm unless otherwise specified.


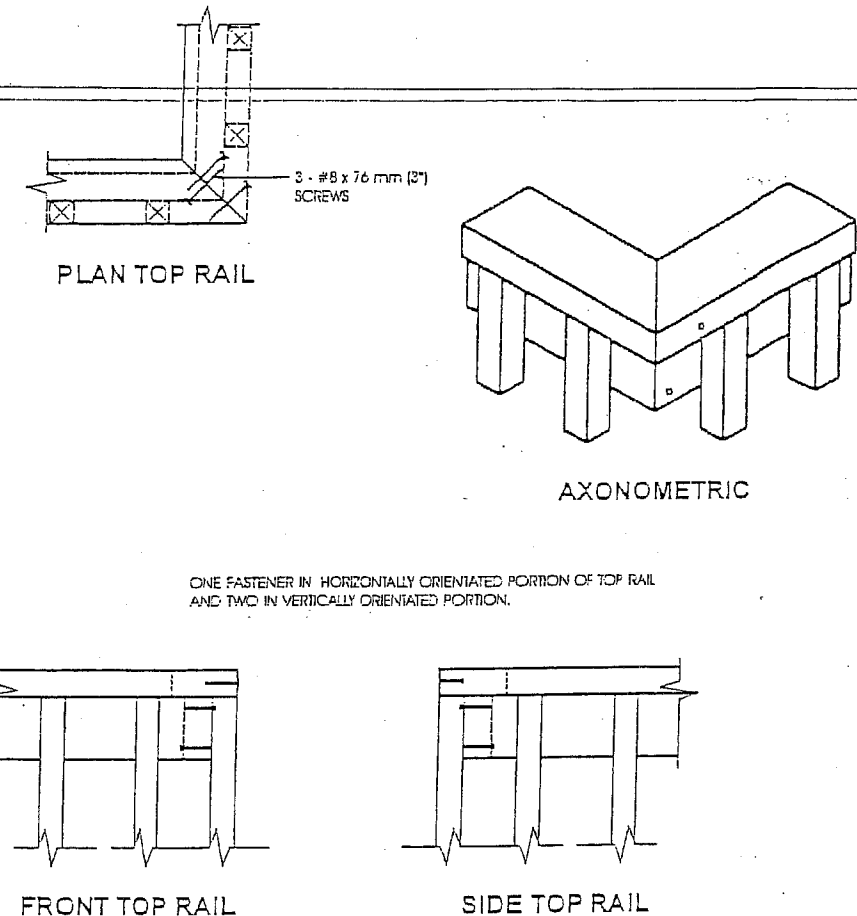


Detail ED-5

Exterior Connection: Corner Joint

Notes:

1. Screws fastening pickets are omitted for clarity.
2. Provide a minimum of 10 pickets beyond the return if end restraint of the guard is provided by this return detail only.

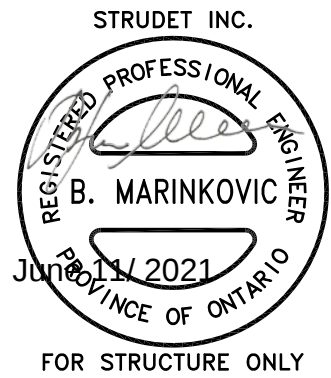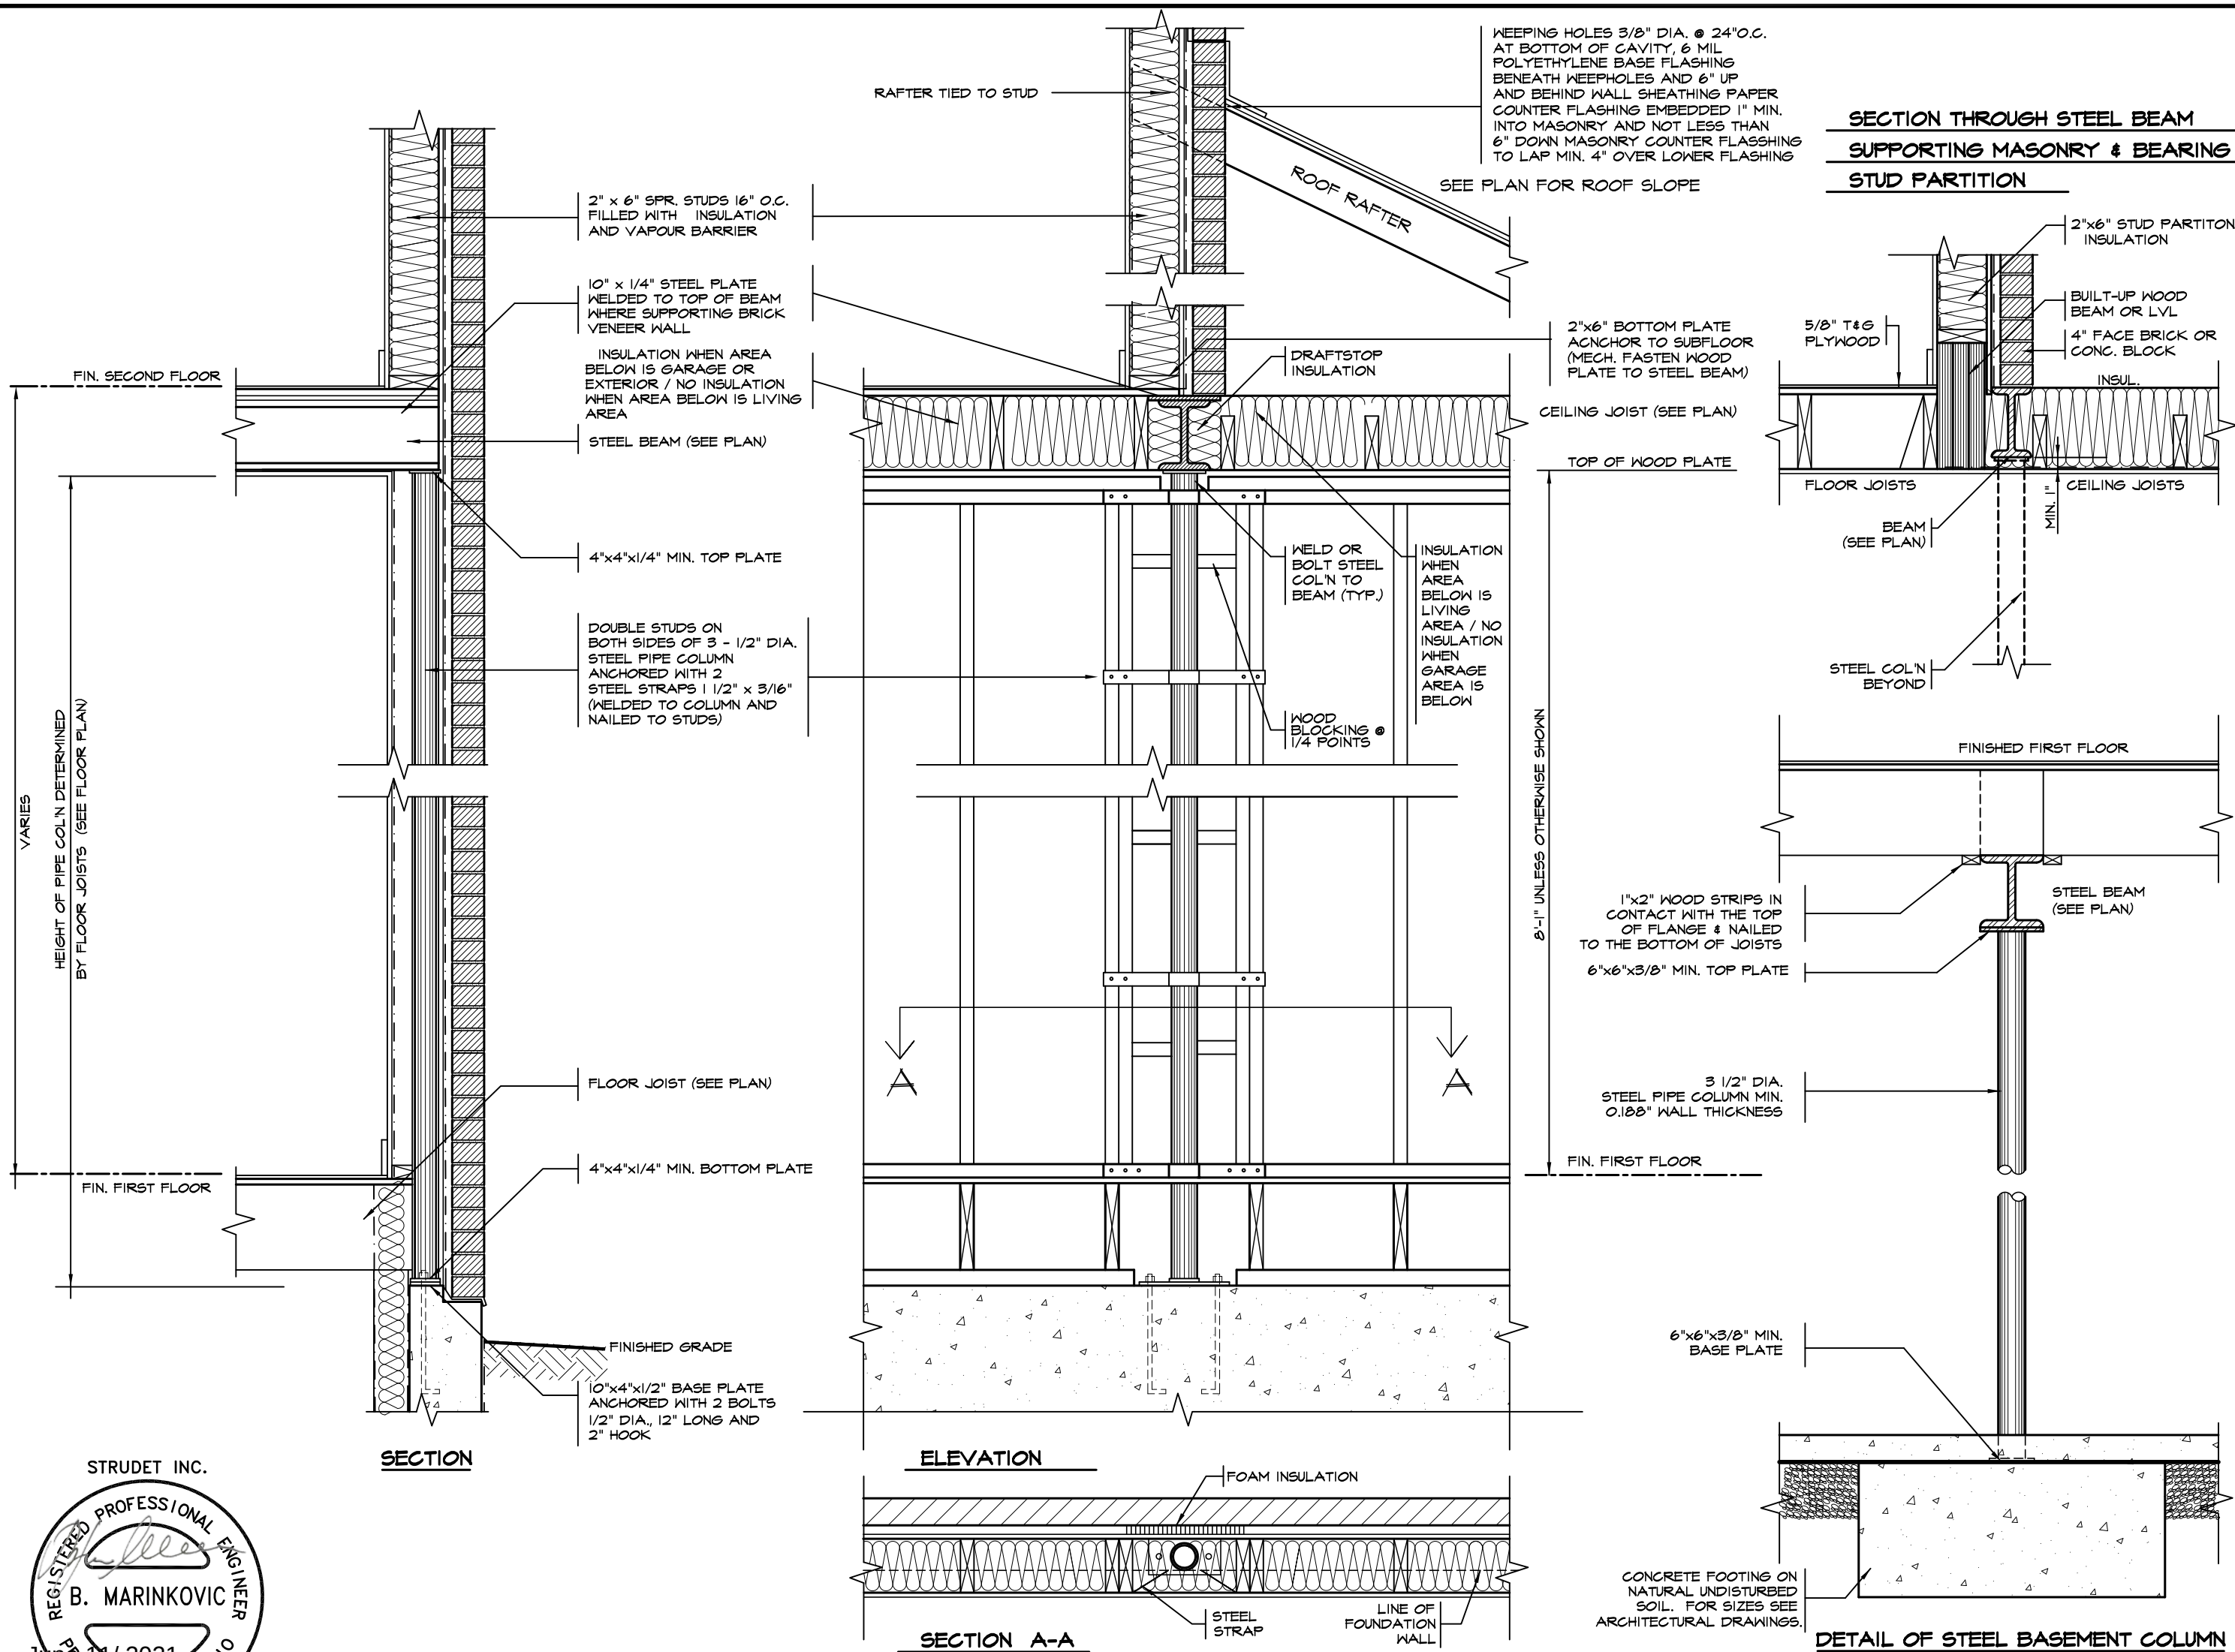

2012 CODE
COMPLIANCE PACKAGE "A1"

5.		
4.		
3.		
2.		
1.	ISSUED FOR PERMIT	JUL 30, 2018
REVISIONS		

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.		
QUALIFICATION INFORMATION		
Required unless design is exempt under Division C, Subsection 3.2.5 of the building code		
VIKAS GAJJAR	28770	BCIN
NAME	SIGNATURE	

REGION DESIGN INC.
8700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4S6
P (416) 736-4096
F (905) 660-0746




SHEET TITLE	
COLUMN DETAILS	
STEEL	
SCALE	3/4"=1'-0"
DATE	JULY 2018

CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.	
PAGE No.	9


PROJECT NAME	ROUNDEL
09/22/2022	

RECEIVED
Per: joshua.nabua

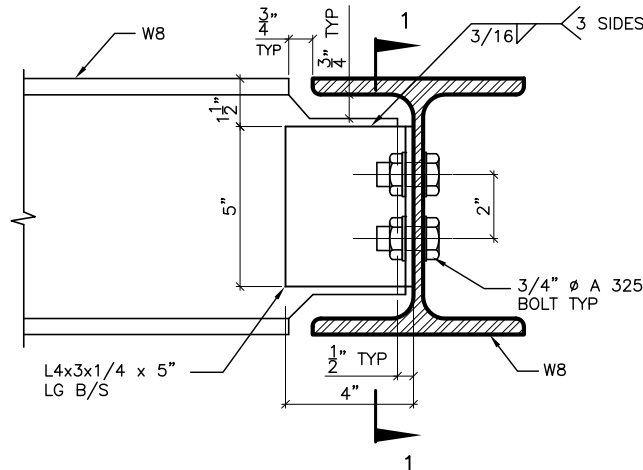


DETAIL 1.

W8
TO
W8
CONNECTION

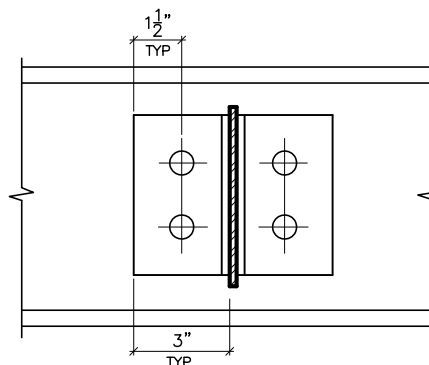


SECTION 1-1

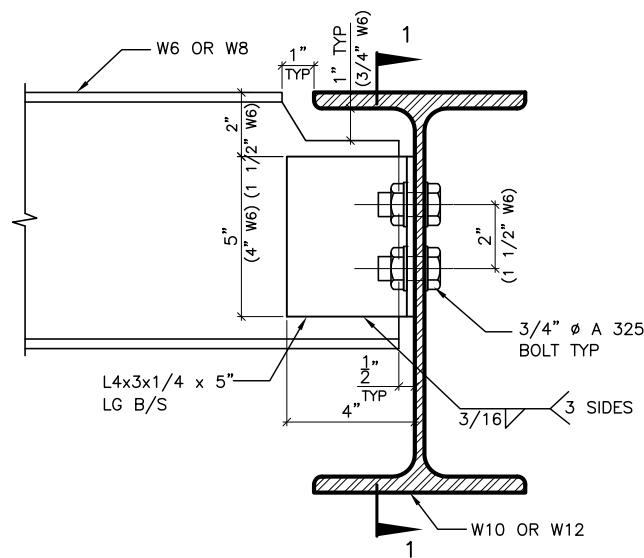


DETAIL 2.

W6(W8)
TO
W10(W12)
CONNECTION

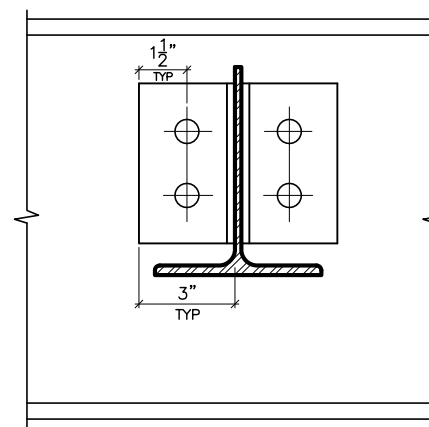


SECTION 1-1

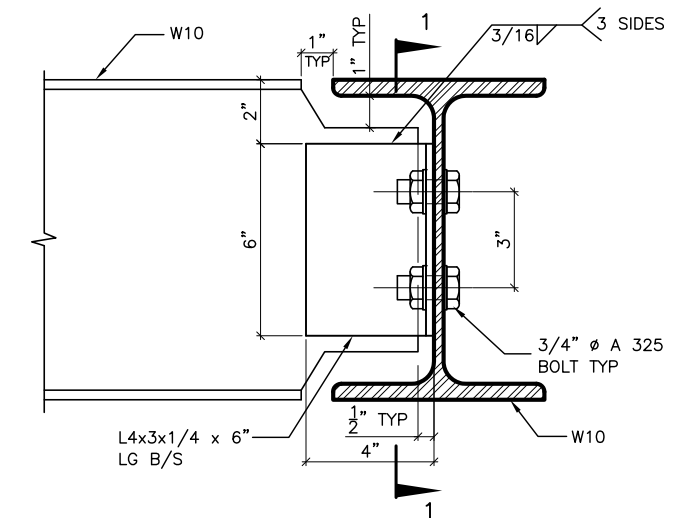


DETAIL 3.

W10
TO
W10
CONNECTION

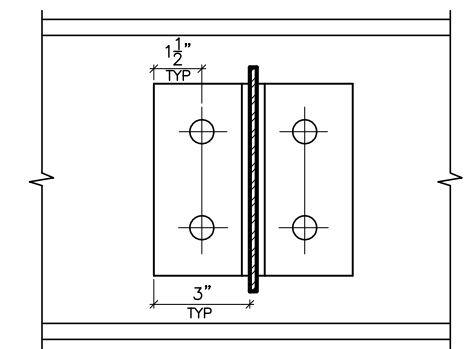


SECTION 1-1

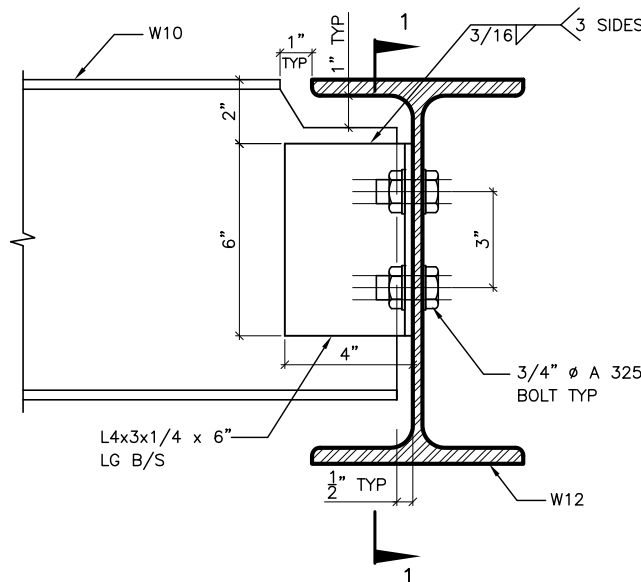


DETAIL 4.

W10
TO
W12
CONNECTION

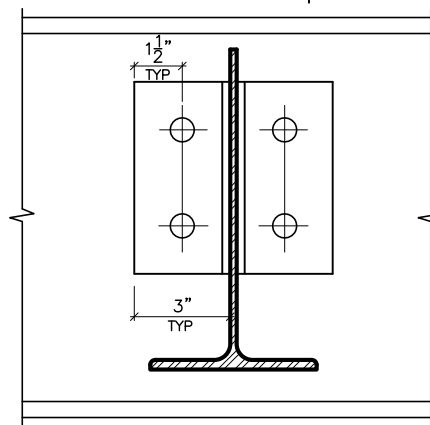


SECTION 1-1

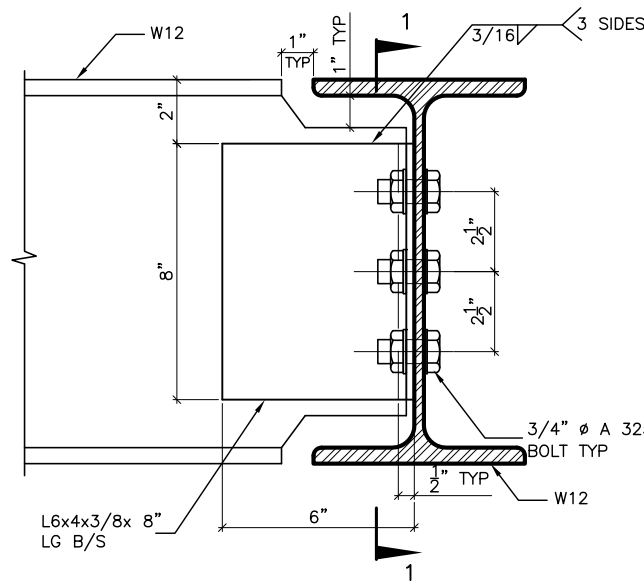

DETAIL 5.

W12
TO
W12
CONNECTION

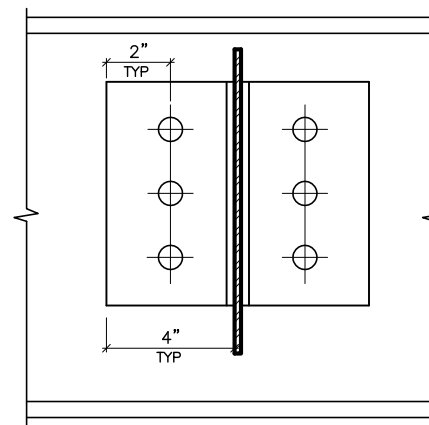


SECTION 1-1




DETAIL 6.

ANGLE
TO
BEAM
CONNECTION

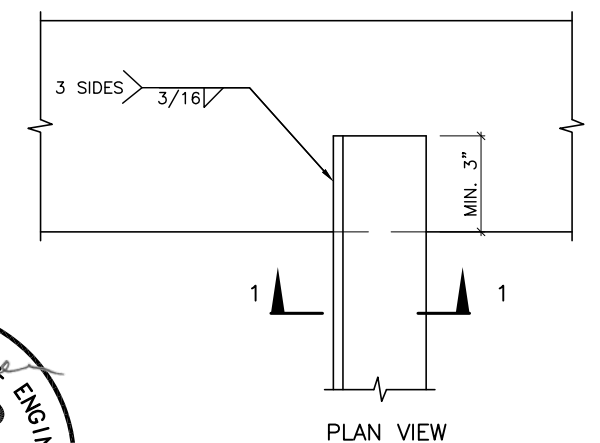

PLAN VIEW

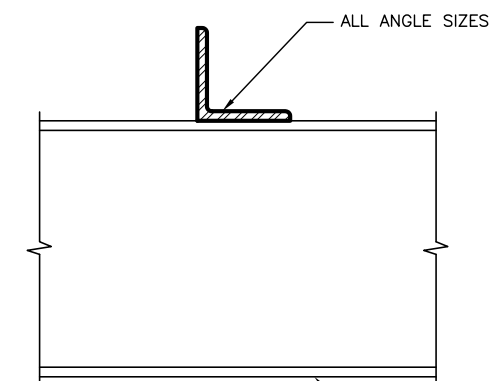

SECTION 1-1 ALL BEAM SIZES

2012 CODE
COMPLIANCE PACKAGE "A1"

5.		
4.		
3.		
2.		
1.	ISSUED FOR PERMIT	JULY 30, 2018
REVISIONS		

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION
Required unless design is exempt under Division C, Subsection 3.2.5 of the building code

VIKAS GAJJAR
NAME

28770
BCIN

SIGNATURE

REGION DESIGN INC.
8700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4S6
P (416) 736-4096
F (905) 660-0746



SHEET TITLE
BEAM DETAILS
STEEL

SCALE
N.T.S.

DATE
JULY 2018


CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.

PAGE No.


10

Greenpark
BUILDING DIVISION
PROJECT NAME
ROUNDEL


RECEIVED
Per: joshua.nabua

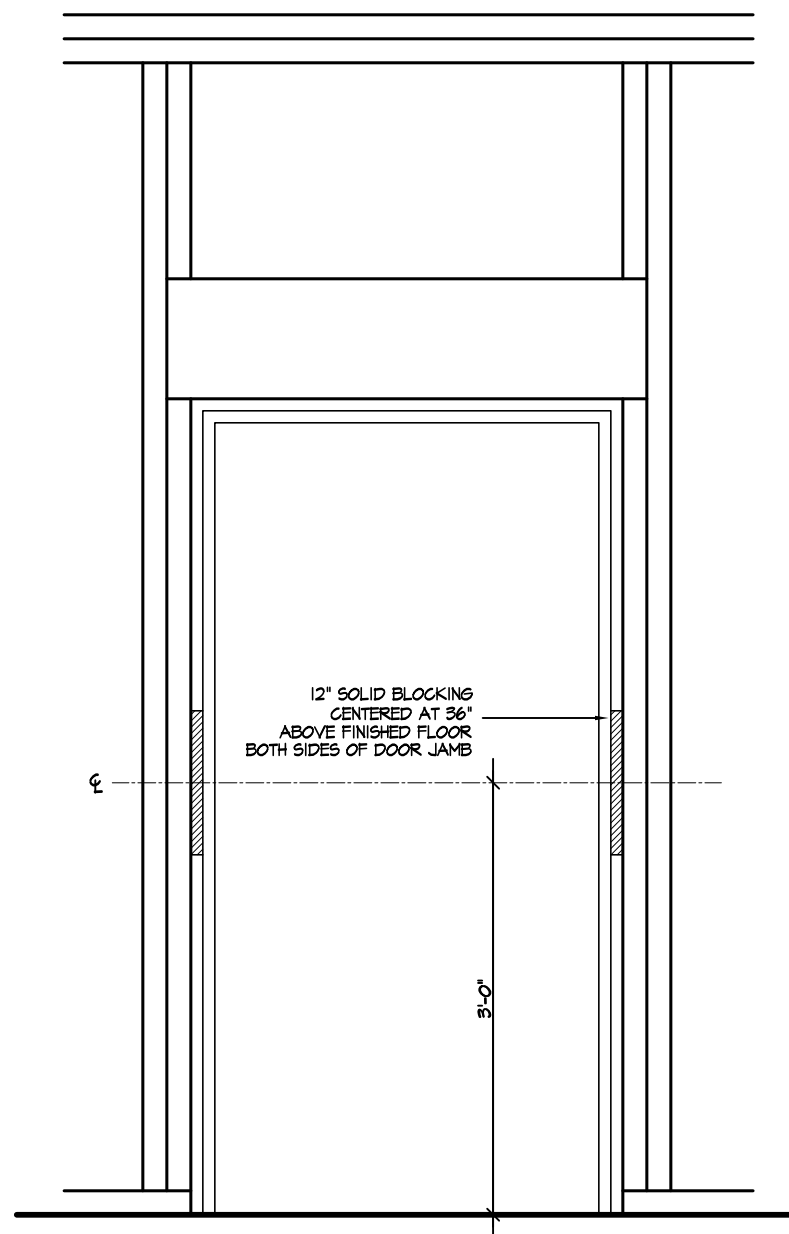


RESISTANCE TO FORCED ENTRY (OBC 9.6.8.)

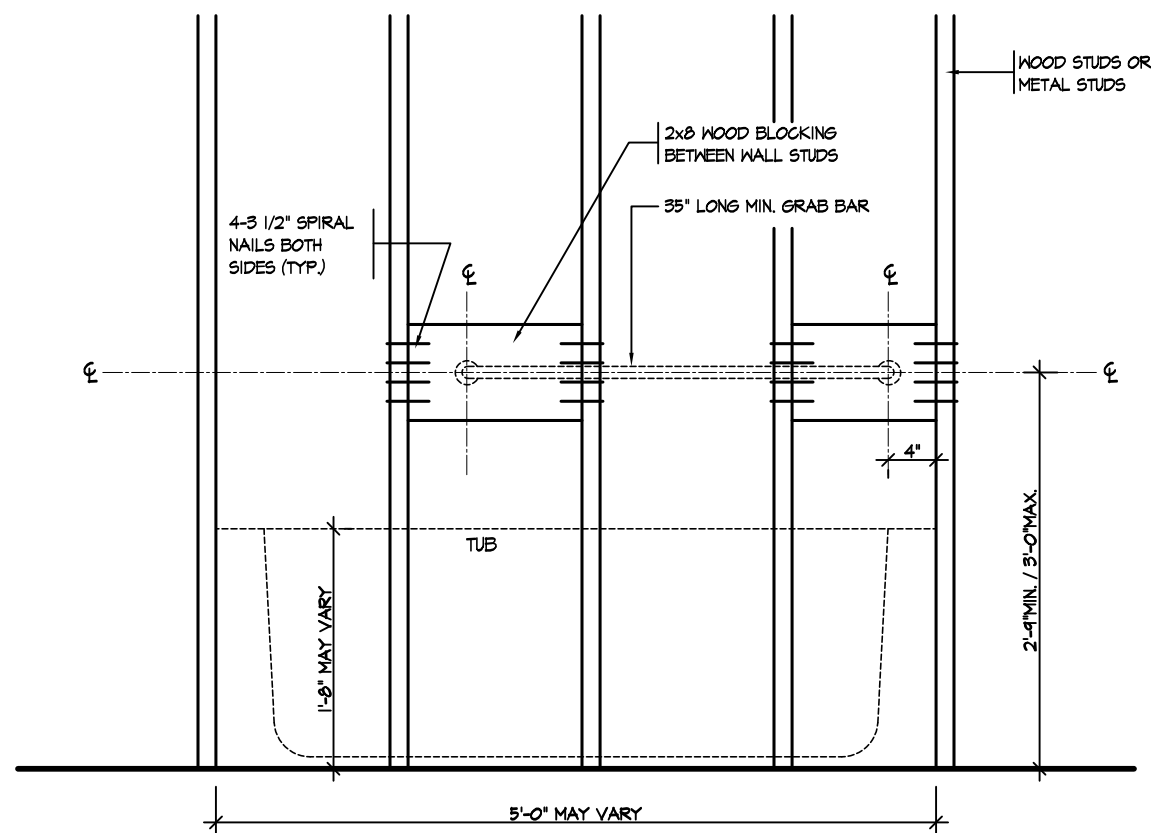

BATH TUB FRONT ELEVATION

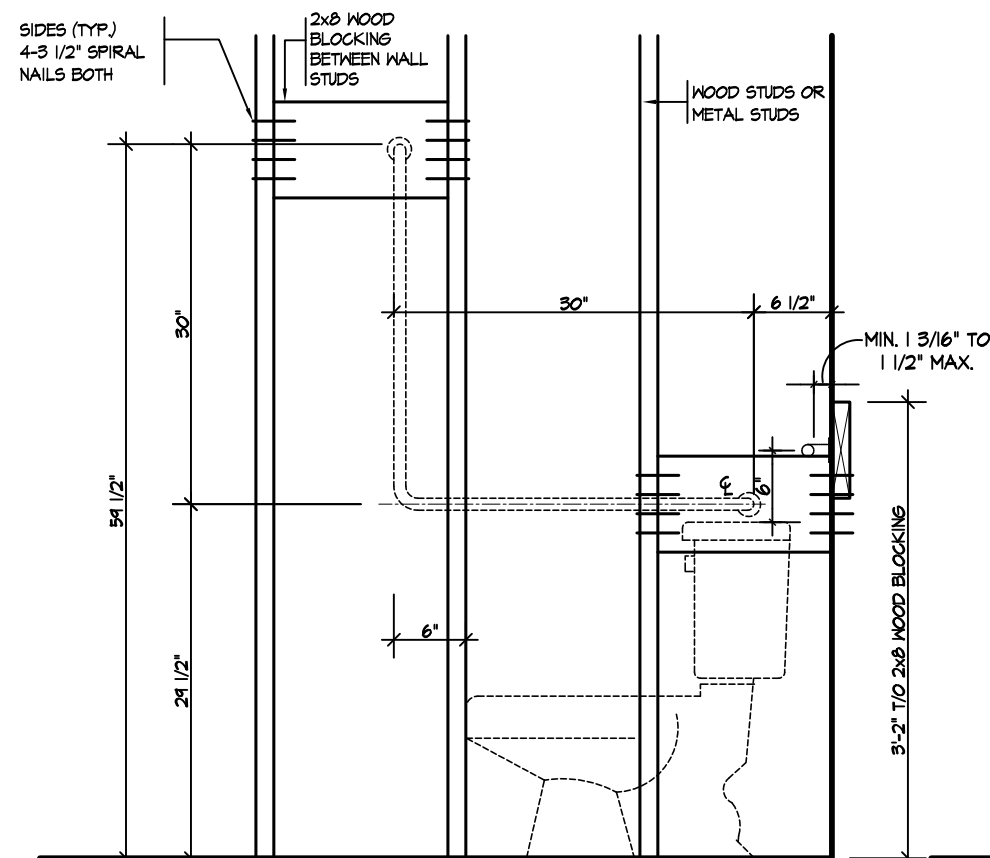

TOILET SIDE ELEVATION

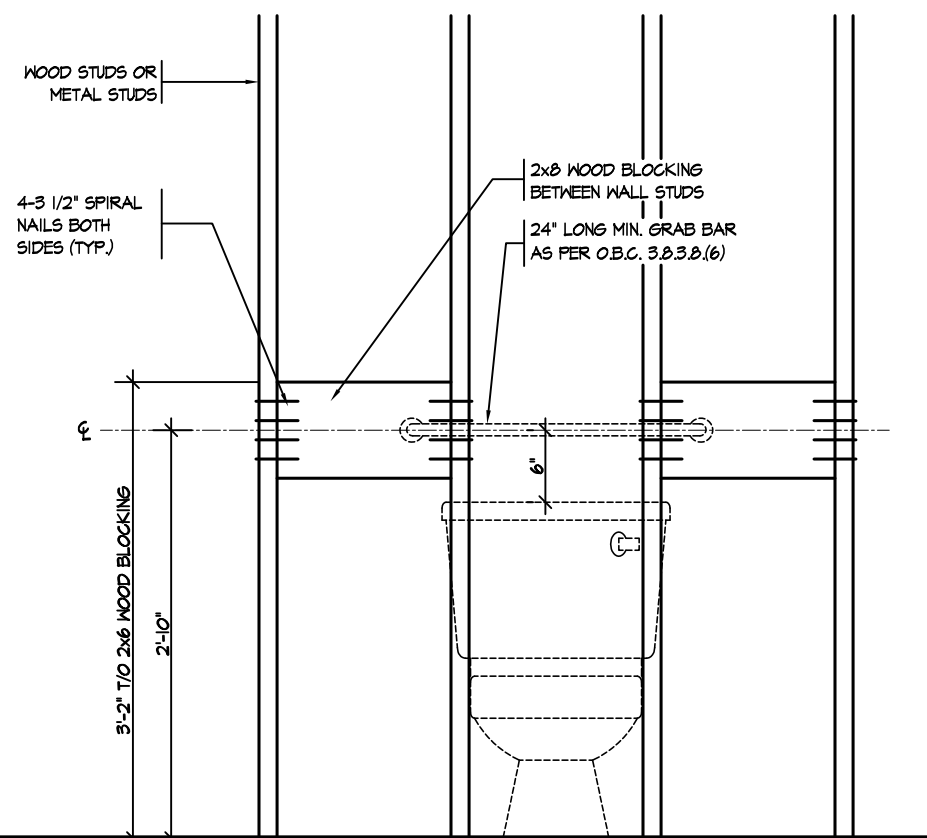

TOILET FRONT ELEVATION

STRUCTURAL REINFORCEMENT FOR GRAB BAR (OBC 9.5.2.3.)



2012 CODE
COMPLIANCE PACKAGE "A1"

5.		
4.		
3.		
2.		
1.	ISSUED FOR PERMIT	JUL 30, 2018
REVISIONS		

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION
Required unless design is exempt under Division C, Subsection 3.2.5 of the building code

VIKAS GAJJAR
NAME

28770
BCIN

SIGNATURE

REGION DESIGN INC.
8700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4S6
P (416) 736-4096
F (905) 660-0746



SHEET TITLE
**BLOCKING
FORCED ENTRY & GRAB BAR**

SCALE
3/4"=1'-0"

DATE
JULY 2018

CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.

PAGE No.


11



PROJECT NAME

ROUNDEL


RECEIVED
Per: joshua.nabua

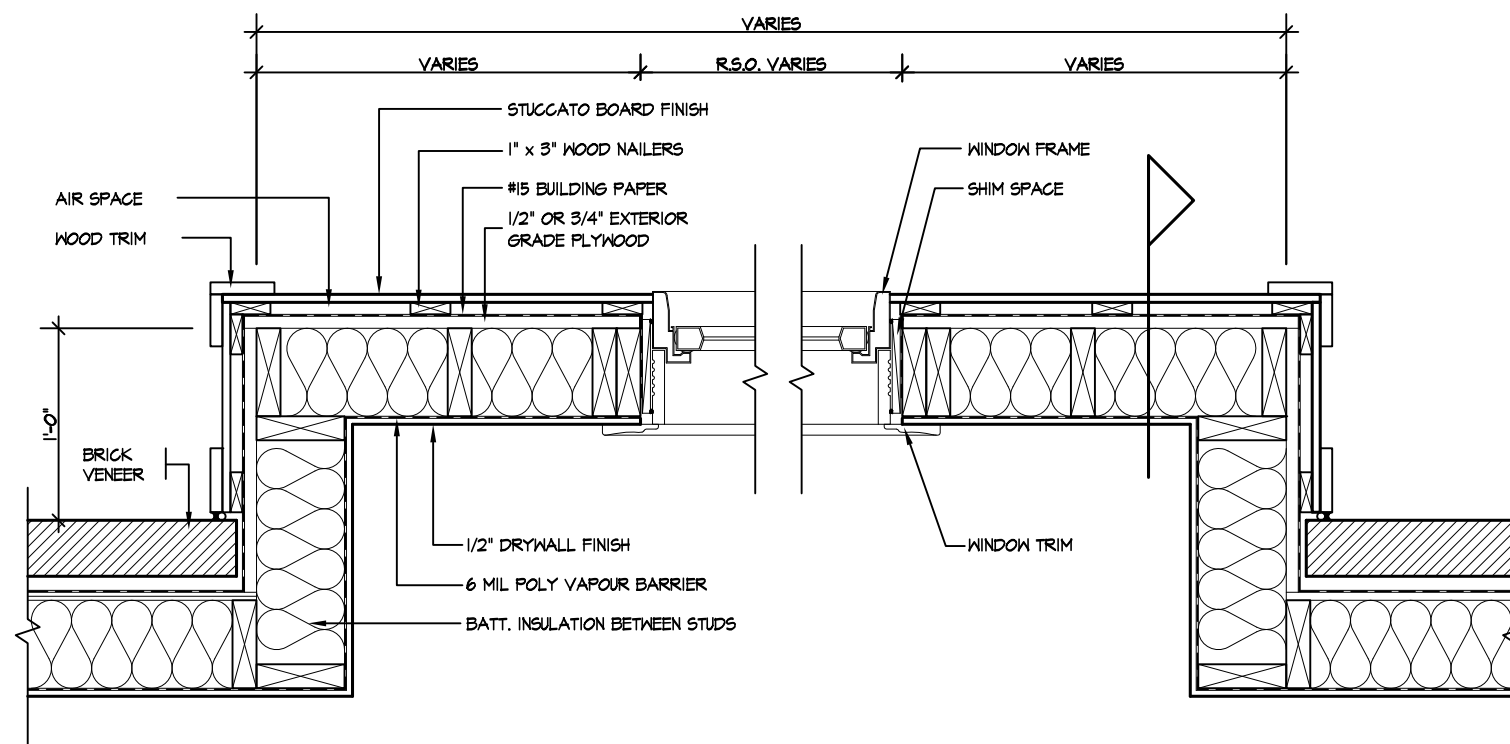


PLAN VIEW

STUCCATO BOARD FINISH CLADDING (OBC 9.27.)

NOTE: Insulation as per SB-12 pkg. A1

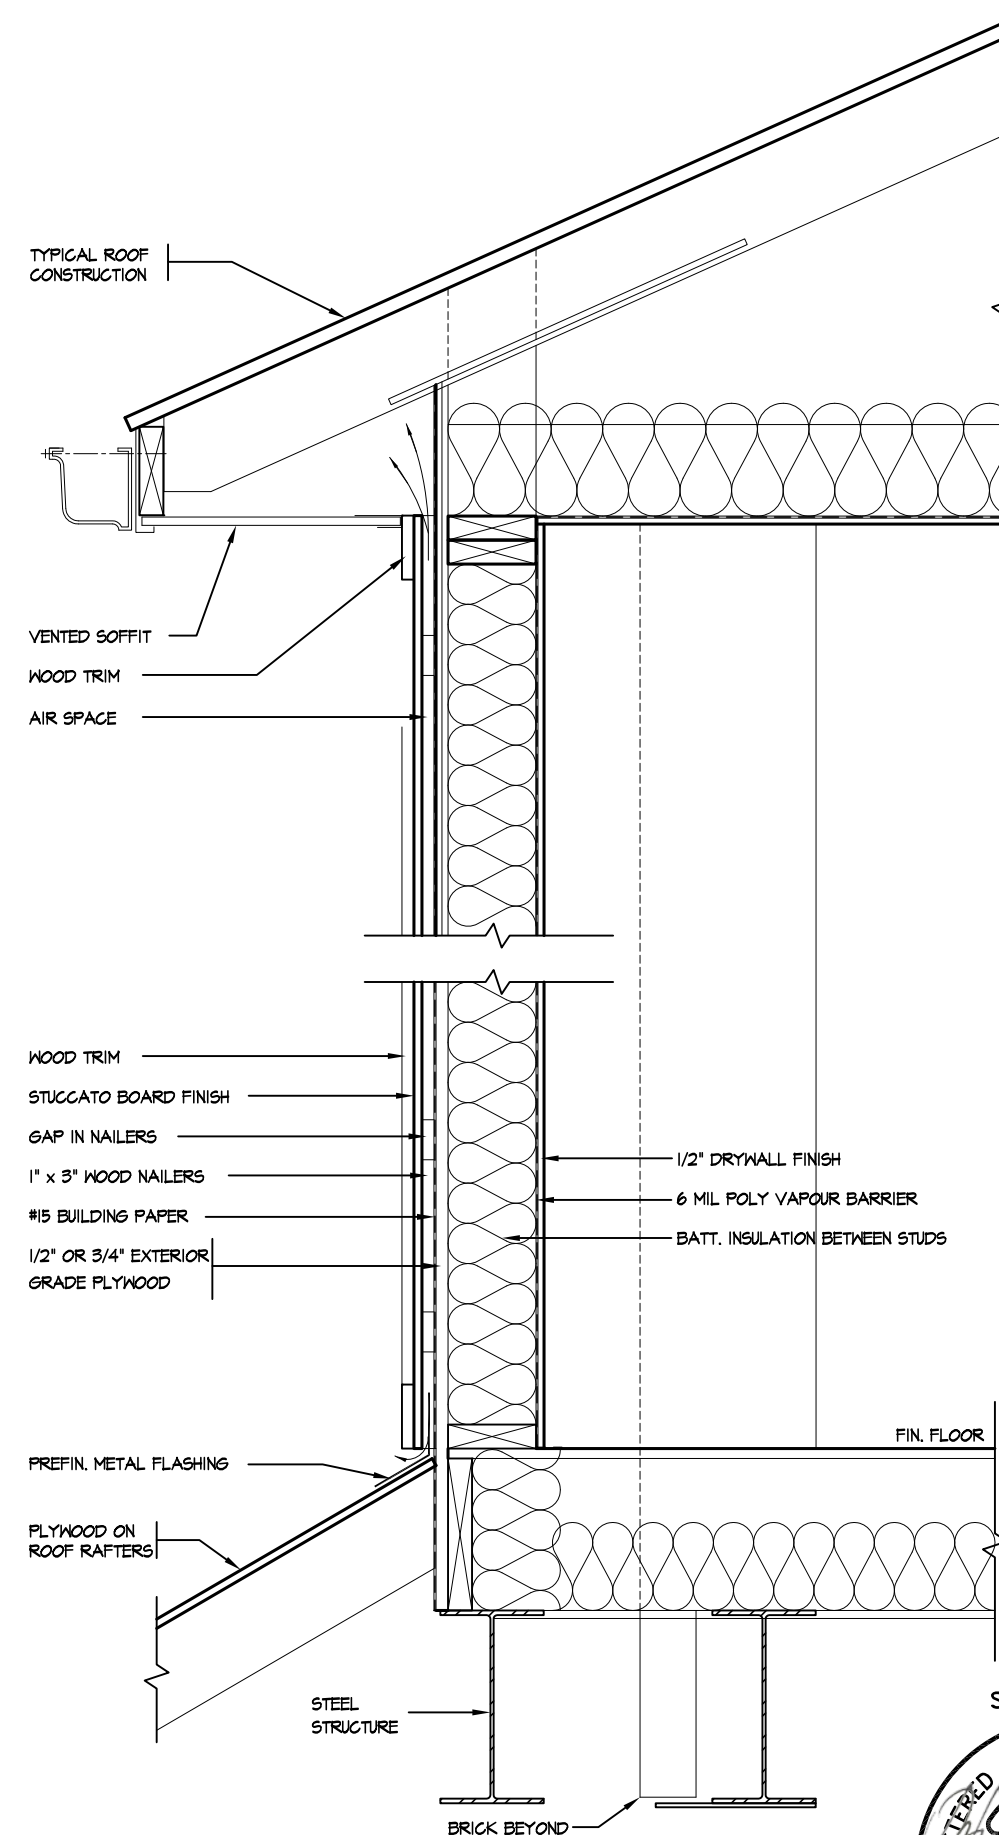


CROSS SECTION

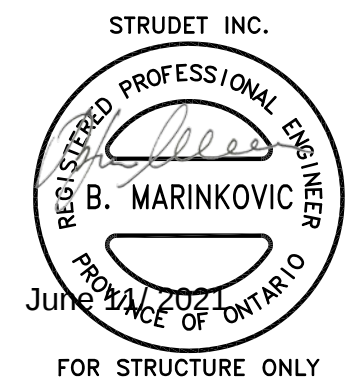


2012 CODE
COMPLIANCE PACKAGE "A1"

5. 4. 3. 2. 1. ISSUED FOR PERMIT JUL 30, 2018 REVISIONS	The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. QUALIFICATION INFORMATION Required unless design is exempt under Division C, Subsection 3.2.5 of the building code VIKAS GAJJAR NAME 28770 BCIN SIGNATURE	REGION DESIGN INC. 8700 DUFFERIN ST. CONCORD, ONTARIO L4K 4S6 P (416) 736-4096 F (905) 660-0746	REGION DESIGN INC.	SHEET TITLE STUCCATO BOARD FINISH CLADDING SCALE 1/2"=1'-0" DATE JULY 2018	CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED. PAGE No. 12	Greenpark 09/22/2022 RECEIVED Per: joshua.nabua PROJECT NAME ROUNDEL
--	--	--	--	---	---	--

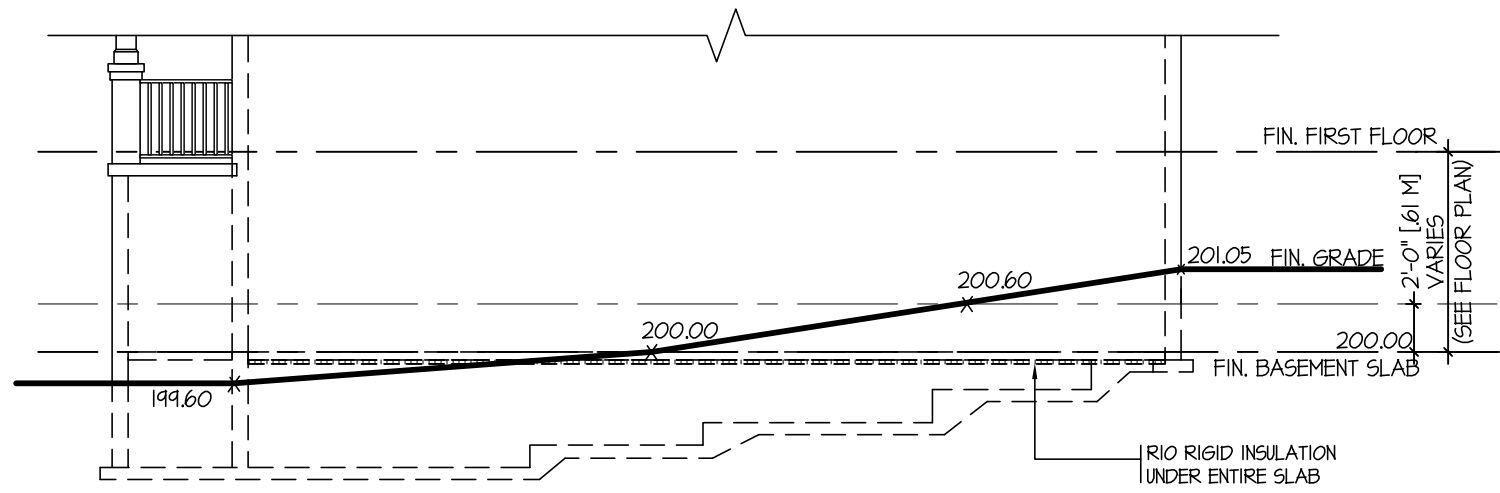


TYPICAL RIGHT SIDE ELEVATION

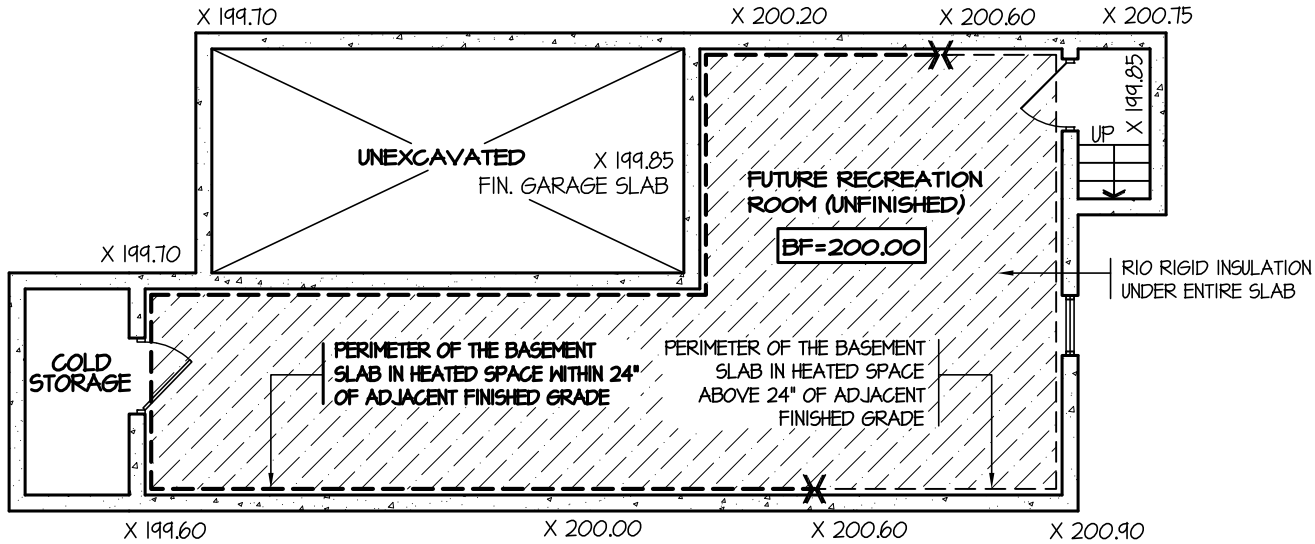


TYPICAL BASEMENT PLAN

SLAB ON GRADE CONDITION

NOTES:
1. LEVELS SHOWN ON THE PLANS ARE FOR ILLUSTRATION PURPOSE ONLY, SEE FINAL GRADING PLAN FOR ACTUAL LEVELS
2. ALL LEVELS ARE SHOWN IN METRIC

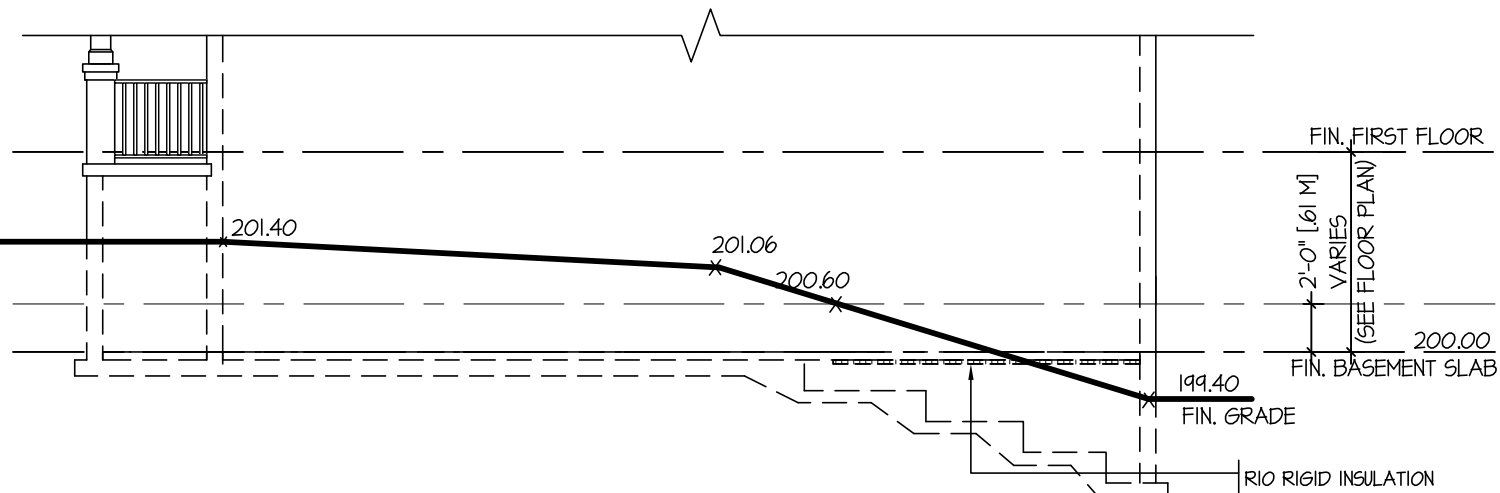


TYPICAL RIGHT SIDE ELEVATION

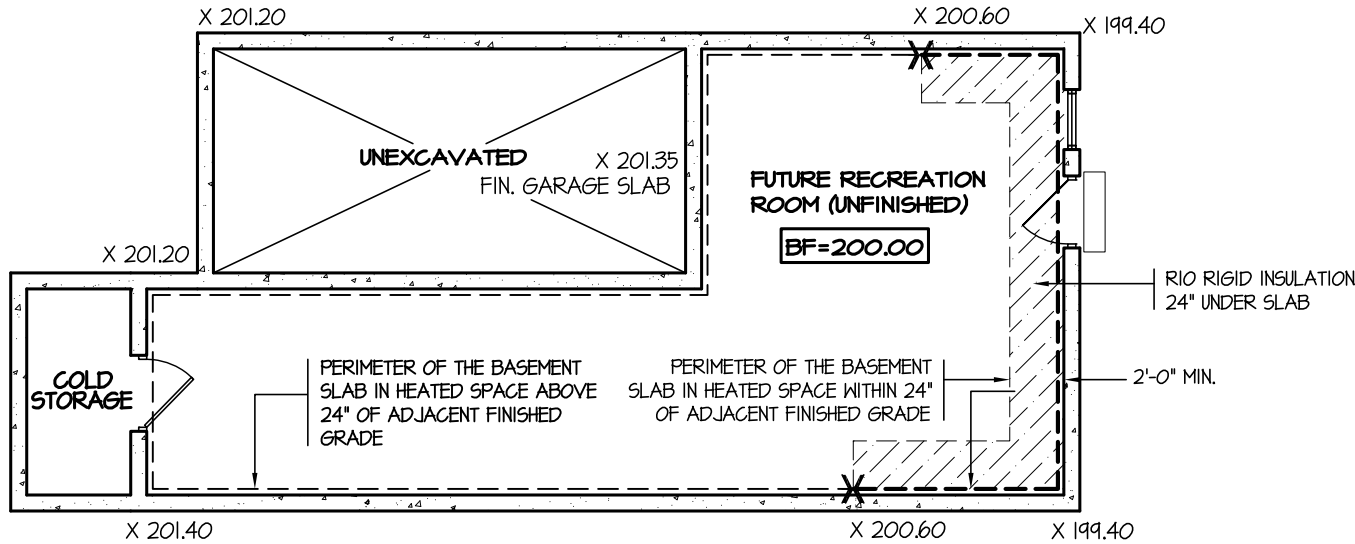

TYPICAL BASEMENT PLAN


WALK OUT BASEMENT CONDITION

NOTES:
1. LEVELS SHOWN ON THE PLANS ARE FOR ILLUSTRATION PURPOSE ONLY, SEE FINAL GRADING PLAN FOR ACTUAL LEVELS
2. ALL LEVELS ARE SHOWN IN METRIC

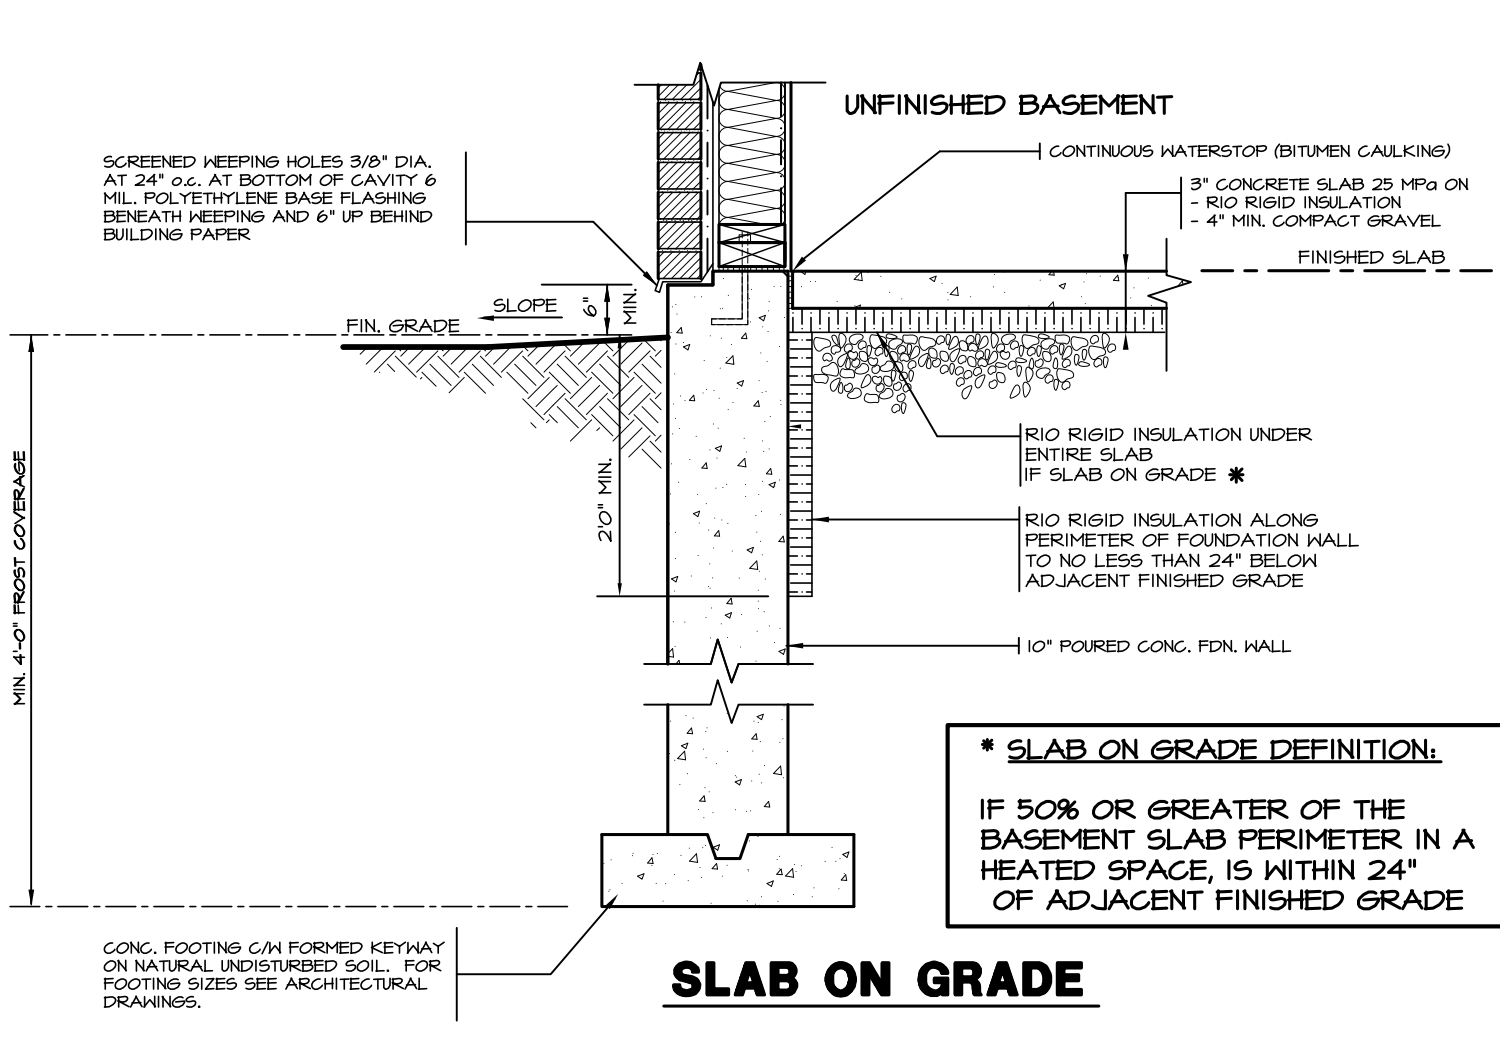

SLAB ON GRADE

* **SLAB ON GRADE DEFINITION:**
IF 50% OR GREATER OF THE BASEMENT SLAB PERIMETER IN A HEATED SPACE, IS WITHIN 24" OF ADJACENT FINISHED GRADE

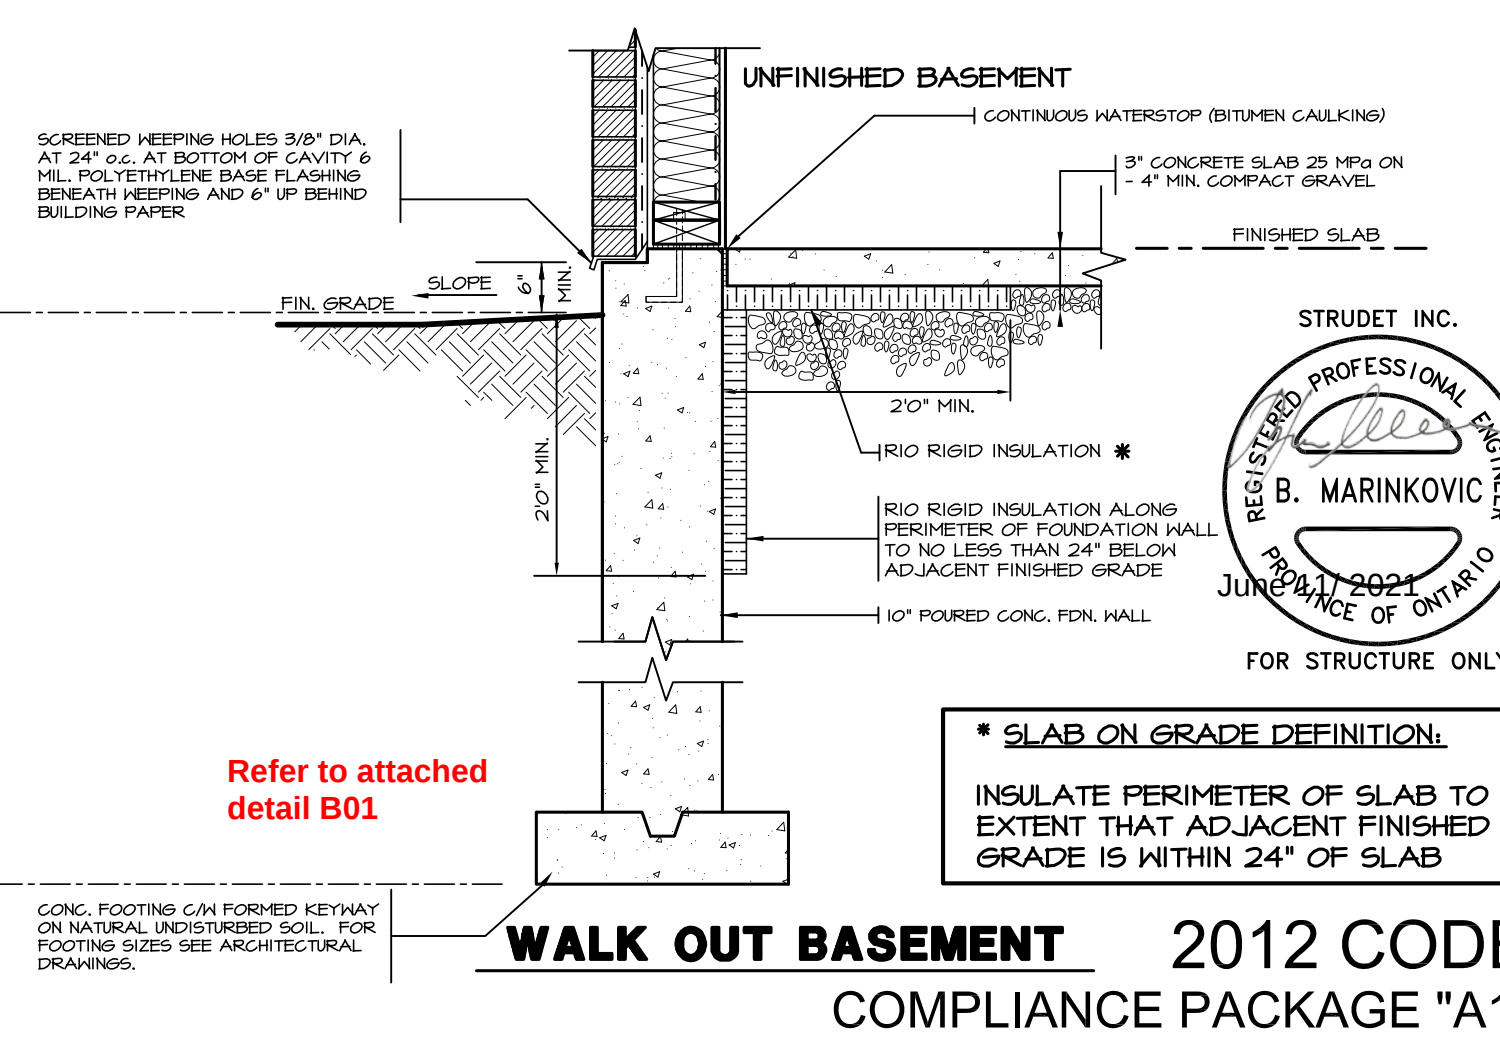

WALK OUT BASEMENT 2012 CODE COMPLIANCE PACKAGE "A1"

* **SLAB ON GRADE DEFINITION:**
INSULATE PERIMETER OF SLAB TO EXTENT THAT ADJACENT FINISHED GRADE IS WITHIN 24" OF SLAB

5.		
4.		
3.		
2.		
1.	ISSUED FOR PERMIT	JUL 30, 2018
REVISIONS		

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION
Required unless design is exempt under Division C, Subsection 3.2.5 of the building code

VIKAS GAJJAR
NAME
28770
BCIN

REGION DESIGN INC.
8700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4S6
P (416) 736-4096
F (905) 660-0746

REGION DESIGN INC.

SHEET TITLE
SLAB ON GRADE WALKOUT BASEMENT

SCALE
N.T.S.

DATE
JULY 2018

CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.


PAGE No.
13

Greenpark

PROJECT NAME
ROUNDEL

RECEIVED
Per: joshua.nabua

10:07:58 AM M:\STANDARD DETAILS\IP 13 - WALKOUT - WALKUP DETAILS PACKAGE A1.DWG June 1, 2021

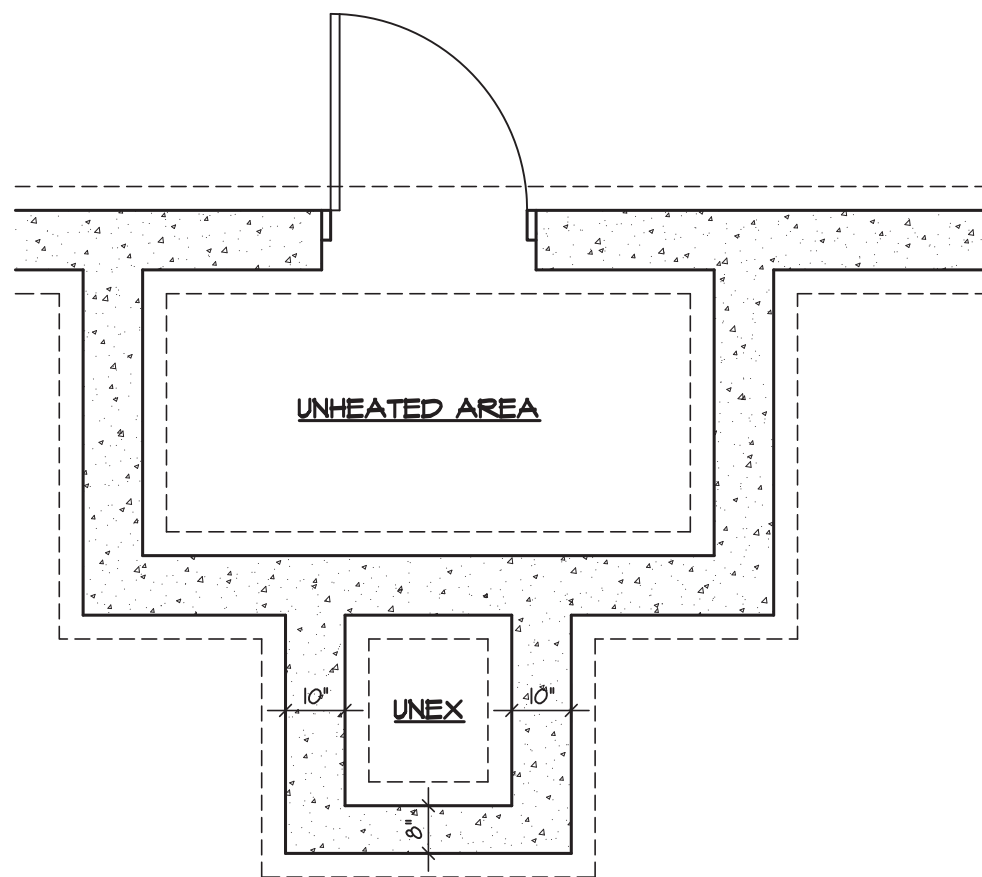

FOUNDATION PLAN

FOR POURED CONCRETE
SLAB STRUCTURE REFER
TO ARCHITECTURAL
DRAWINGS


GUARD &
HANDRAIL

NOSING
REINF. W/
10M BARS

GROUND FLOOR PLAN

GENERAL NOTES

- EXTERIOR STAIRS**
7 7/8" RISE MAXIMUM
10" RUN MINIMUM
14" TREAD MAXIMUM
- MASONRY TIES**
WHEN BRICK FACING IS USED ABOVE
GROUND LEVEL, PROVIDE 3/16" DIA.
CORROSION RESISTANT METAL TIES @ 36"
HORIZONTAL & 8" VERTICAL
- GUARDS**
ARE REQUIRED AROUND CONCRETE SLAB
IF MORE THAN 2'-0" ABOVE GRADE & ON
BOTH SIDES OF STAIRS CONTAINING MORE
THAN 6 RISERS. MINIMUM 31" HIGH FOR
STAIRS MINIMUM 35" HIGH FOR PORCHES
UP TO 5'-11" ABOVE GRADE. MINIMUM 42"
HIGH FOR GREATER HTS.
- HANDRAIL**
ARE REQUIRED WHERE STEPS HAVE MORE
THAN 3 RISERS. HANDRAIL HEIGHT 31" -
38".
- FOUNDATION WALLS**
THICKNESS OF FOUNDATION WALLS IS
DEPENDANT UPON VENEER CUT 8" FOR UP
TO 26" VENEER CUT HEIGHT 10" FOR
VENEER CUT OVER 26" HIGH
- CONCRETE**
MINIMUM CONCRETE STRENGTH SHALL BE
4650 PSI [32MPa] W/ 5%-8% AIR
ENTRAINMENT MINIMUM CONCRETE SLAB
THICKNESS 5"
- CONCRETE COVER**
PROVIDE MINIMUM 3/4" CLEAR CONCRETE
COVER TO REINFORCING BARS

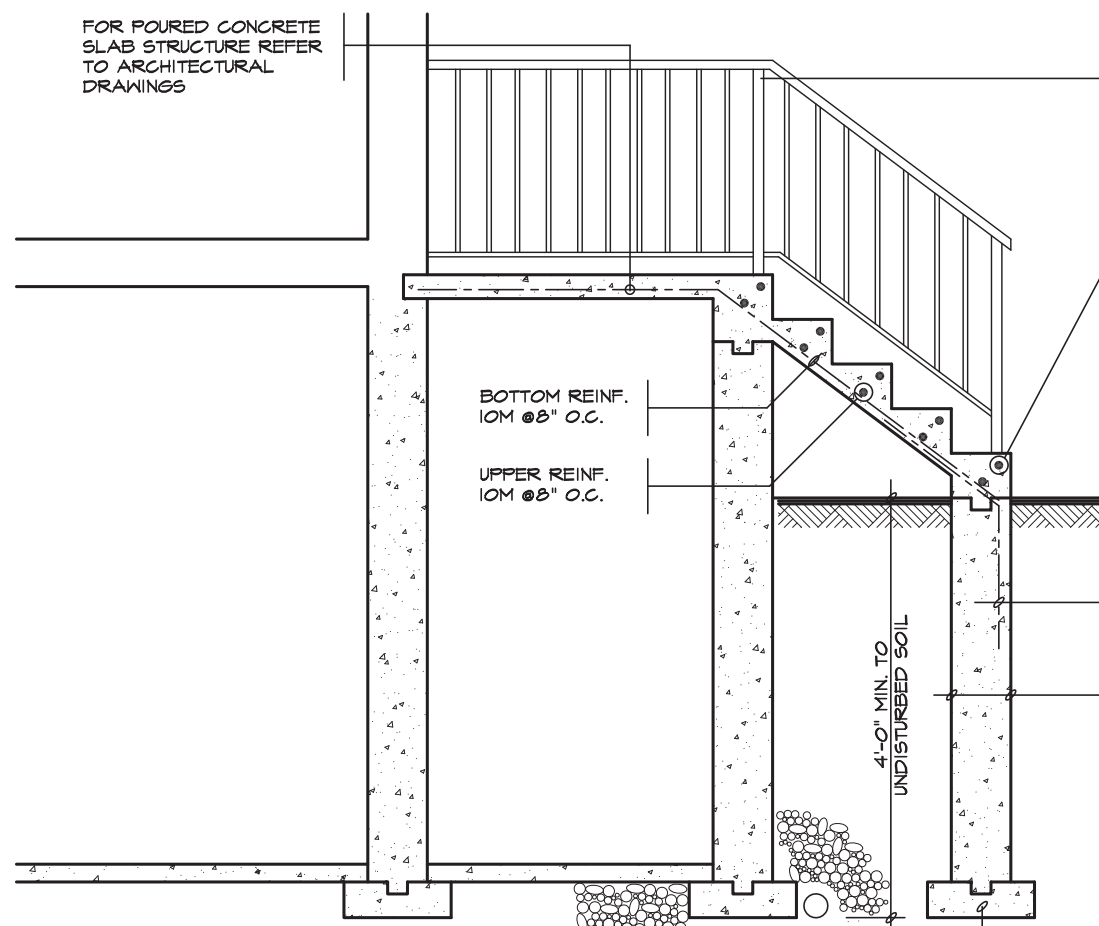

SECTION 'A'

CLEAR SPACING
BETWEEN PICKETS TO
BE 4" MAX. NO
MEMBER BETWEEN 4" &
2'-11" ABOVE SLAB


NOSING
REINF. W/
10M BARS

MASONRY EXTERIOR
FACING, FILL SPACE
BETWEEN WALL &
FACING W/ MORTAR
& PROVIDE METAL
TIES SEE NOTE '2'

10M @ 8" O.C.
DOWELS TO
MATCH BOTTOM
REINF.

POURED FDN. WALL

6" X16"
POURED
CONC.
FOOTING

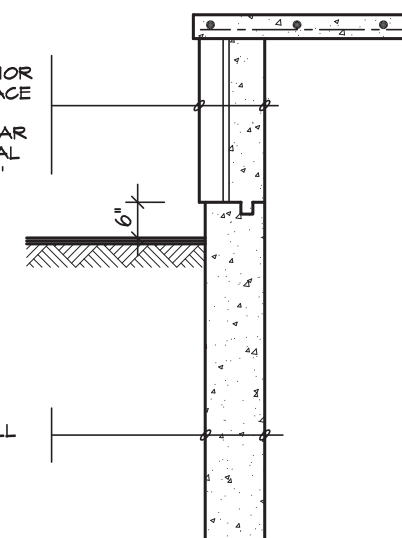

SECTION 'B'

NOTE: FOR MORE THAN 8 RISERS



FOR STRUCTURE ONLY
2012 CODE
COMPLIANCE PACKAGE "A1"

5.		The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. QUALIFICATION INFORMATION Required unless design is exempt under Division C, Subsection 3.2.5 of the building code VIKAS GAJJAR  28770 NAME SIGNATURE BCIN	REGION DESIGN INC. 8700 DUFFERIN ST. CONCORD, ONTARIO P (416) 736-4096 F (905) 660-0746	REGION DESIGN INC.	SHEET TITLE	CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.	 Greenpark PROJECT NAME	
4.					POURED CONCRETE STAIRS			PAGE No.
3.					SCALE			14
2.					DATE			09/22/2022
1.	ISSUED FOR PERMIT				JUL 30, 2018			ROUND
REVISIONS								