

NOT THE GRANTING OF A PERMIT NOR REVIEWING OF SPECS
& DRAWINGS NOR INSPECTIONS MADE DURING INSTALLATION
BY THE OFFICIAL HAVING JURISDICTION SHALL RELIEVE THE
OWNER FROM REQUIREMENTS OF THE ONTARIO BUILDING
CODE AND ANY OTHER REFERENCED REQUIREMENTS.

Block 121 Units 1 to 6

SITE NAME: BARLASSINA				DATE: Aug-22				WINTER NATURAL AIR CHANGE RATE 0.319				HEAT LOSS ΔT °F. 72				CSA-F280-12			
BUILDER: GREENPARK HOMES				TYPE: CHERRY 12				GFA: 2354				LO# 98652				SUMMER NATURAL AIR CHANGE RATE 0.085			
ROOM USE	EXP. WALL	CLG. HT.	MBR	ENS	BED-2	BEO-3	BEO-4	BATH				ENS-3							
			13	21	11	37	14	9				11							
			9	9	9	9	9	9				9							
FACTORS																			
GRS.WALL AREA	LOSS	GAIN	117	189	99	333	126	81				99							
GLAZING	LOSS	GAIN	LOSS	GAIN	LOSS	GAIN	LOSS	GAIN				LOSS	GAIN						
NORTH	20.3	15.0	0	0	0	0	0	0				0	0	0					
EAST	20.3	40.5	0	0	0	0	0	0				0	0	0					
SOUTH	20.3	23.9	0	0	0	0	0	0				0	0	0					
WEST	20.3	40.5	24	487	973	10	203	405				24	487	573					
SKYLT.	35.5	99.8	0	0	0	0	0	0				0	0	0					
DOORS	19.1	2.4	0	0	0	0	0	0				0	0	0					
NET EXPOSEO WALL	4.3	0.5	93	395	50	167	710	90				0	0	0					
NET EXPOSED BSMT WALL ABOVE GR	3.4	0.4	0	0	0	0	0	0				0	0	0					
EXPOSEO CLG	1.2	0.5	390	477	205	108	132	57				0	0	0					
NO ATTIC EXPOSEO CLG	2.6	1.1	0	0	0	0	0	0				0	0	0					
EXPOSEO FLOOR	2.4	0.3	0	0	0	0	0	0				0	0	0					
BASEMENT/CRAWL HEAT LOSS			0	0	0	0	0	0				0	0	0					
SLAB ON GRADE HEAT LOSS			0	0	0	0	0	0				0	0	0					
SUBTOTAL HT LOSS			1359		1288														
SUB TOTAL HT GAIN				1229		839							984						
LEVEL FACTOR / MULTIPLIER		0.20	0.27		0.20	0.27						0.20	0.27						
AIR CHANGE HEAT LOSS			371		351								268						
AIR CHANGE HEAT GAIN				51		35							29						
DUCT LOSS			0		0							0							
DUCT GAIN			0		0							0							
HEAT GAIN PEOPLE	240		2	480	0	0						0	0						
HEAT GAIN APPLIANCES/LIGHTS				481	0							0	0						
TOTAL HT LOSS BTU/H			1729		1639								0						
TOTAL HT GAIN x 1.3 BTU/H				2913		1137							1252						
													935						

ROOM USE	EXP. WALL	CLG. HT.	LIB	OIN	KT/FM	LAUN	PWO	FOY											
			37	27	42	0	6	28											
			10	10	10	9	10	10											
FACTORS																			
GRS.WALL AREA	LOSS	GAIN	370	270	420														
GLAZING	LOSS	GAIN	LOSS	GAIN	LOSS	GAIN	LOSS	GAIN				LOSS	GAIN						
NORTH	20.3	15.0	0	0	0	0	0	0				0	0	0					
EAST	20.3	40.5	30	608	1216	0	0	0				0	0	0					
SOUTH	20.3	23.9	15	304	358	33	669	788				10	203	239					
WEST	20.3	40.5	0	0	0	0	82	1662				0	0	0					
SKYLT.	35.5	99.8	0	0	0	0	0	0				0	0	0					
DOORS	19.1	2.4	0	0	0	0	0	0				0	0	0					
NET EXPOSEO WALL	4.3	0.5	325	1382	176	237	1008	128				48	917	117					
NET EXPOSED BSMT WALL ABOVE GR	3.4	0.4	0	0	0	0	0	0				0	0	0					
EXPOSEO CLG	1.2	0.5	0	0	0	0	0	0				0	0	0					
NO ATTIC EXPOSED CLG	2.6	1.1	0	0	0	0	0	0				0	0	0					
EXPOSEO FLOOR	2.4	0.3	0	0	0	0	0	0				0	0	0					
BASEMENT/CRAWL HEAT LOSS			0	0	0	0	0	0				0	0	0					
SLAB ON GRADE HEAT LOSS			0	0	0	0	0	0				0	0	0					
SUBTOTAL HT LOSS			2294		1677														
SUB TOTAL HT GAIN				1750		916							2063						
LEVEL FACTOR / MULTIPLIER		0.30	0.39		0.30	0.39						0.30	0.39						
AIR CHANGE HEAT LOSS			883		646								794						
AIR CHANGE HEAT GAIN				73		38							20						
DUCT LOSS			0		0							0							
DUCT GAIN			0		0							0							
HEAT GAIN PEOPLE	240		0	0	0	0						0	0						
HEAT GAIN APPLIANCES/LIGHTS				481		481						0	0						
TOTAL HT LOSS BTU/H			3177		2322								0						
TOTAL HT GAIN x 1.3 BTU/H				2996		1866							2858						
													644						

TOTAL HEAT GAIN BTU/H:

28814

TONS: 2.40

LOSS DUE TO VENTILATION LOAD BTU/H: 1554

STRUCTURAL HEAT LOSS: 39793

TOTAL COMBINED HEAT LOSS BTU/H: 41347

Michael O'Rourke

SITE NAME: BARLASSINA
 BUILDER: GREENPARK HOMES

TYPE: CHERRY 12

DATE: Aug-22

GFA: 2354

LO# 98652

HEATING CFM 928 COOLING CFM 928
 TOTAL HEAT LOSS 39,793 TOTAL HEAT GAIN 28,616
 AIR FLOW RATE CFM 23.32 AIR FLOW RATE CFM 32.43

furnace pressure 0.6
 furnace filter 0.05
 a/c coil pressure 0.2
 available pressure
 for s/a & r/a 0.35

#GOODMAN
 GMEC960603BNA 60
 FAN SPEED
 LOW

AFUE = 96 %
 INPUT (BTU/H) = 60,000
 OUTPUT (BTU/H) = 57,600

RUN COUNT	4th	3rd	2nd	1st	Bas
S/A	0	0	11	8	3
R/A	0	0	5	1	1

All S/A diffusers 4"x10" unless noted otherwise on layout.

All S/A runs 5'Ø unless noted otherwise on layout.

plenum pressure s/a 0.18
 max s/a dif press. loss 0.02
 min adjusted pressure s/a 0.16

r/a pressure 0.17
 r/a grille press. Loss 0.02
 adjusted pressure r/a 0.15

MEDLOW
 MEDIUM 928
 MEDIUM HIGH 1017
 HIGH 1131

DESIGN CFM = 928
 CFM @ .6" E.S.P.

TEMPERATURE RISE 57 °F

RUN #	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	21	22	23
ROOM NAME	MBR	ENS	BED-2	BED-2	BED-3	BED-4	BATH	BED-3	LIB	MBR	ENS-3	LIB	DIN	KT/FM	KT/FM	KT/FM	LAUN	PWD	FOY	BAS	BAS	BAS
RM LOSS MBH.	0.86	1.64	1.15	1.15	1.84	1.17	0.84	1.84	1.59	0.86	1.25	1.59	2.32	1.71	1.71	1.71	0.21	0.69	2.86	4.27	4.27	4.27
CFM PER RUN HEAT	20	38	27	27	43	27	20	43	37	20	29	37	54	40	40	40	5	16	67	100	100	100
RM GAIN MBH.	1.46	1.14	1.58	1.58	1.92	1.52	0.51	1.92	1.50	1.46	0.94	1.50	1.87	2.11	2.11	2.11	0.74	0.52	0.64	0.50	0.50	0.50
CFM PER RUN COOLING	47	37	51	51	62	49	17	62	49	47	30	49	61	69	69	69	24	17	21	16	16	16
ADJUSTED PRESSURE	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.16	0.16	0.16
ACTUAL DUCT LGH.	35	43	57	60	64	35	42	54	52	36	37	44	27	27	29	21	46	39	26	29	16	39
EQUIVALENT LENGTH	150	200	180	120	180	140	150	160	130	160	150	130	140	80	130	110	130	110	140	130	120	140
TOTAL EFFECTIVE LENGTH	185	243	237	180	244	175	192	214	182	196	187	174	167	107	159	131	176	149	166	159	136	179
ADJUSTED PRESSURE	0.09	0.07	0.07	0.1	0.07	0.1	0.09	0.08	0.09	0.09	0.09	0.1	0.1	0.16	0.11	0.13	0.1	0.12	0.1	0.1	0.12	0.09
ROUND DUCT SIZE	5	4	5	5	6	6	4	6	5	5	4	5	5	5	5	5	4	4	5	6	6	6
HEATING VELOCITY (ft/min)	147	436	198	198	219	138	229	219	272	147	333	272	396	294	294	294	57	184	492	510	510	510
COOLING VELOCITY (ft/min)	345	424	374	374	316	250	195	316	360	345	344	360	448	507	507	507	275	195	154	82	82	82
OUTLET GRILL SIZE	3X10	3X10	3X10	3X10	4X10	4X10	3X10	4X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	4X10	4X10	4X10
TRUNK	C	D	A	B	A	D	D	A	A	C	B	A	B	D	C	C	B	B	B	C	D	A

RUN #	ROOM NAME	RM LOSS MBH.	CFM PER RUN HEAT	RM GAIN MBH.	CFM PER RUN COOLING	ADJUSTED PRESSURE	ACTUAL DUCT LGH.	EQUIVALENT LENGTH	TOTAL EFFECTIVE LENGTH	ADJUSTED PRESSURE	ROUND DUCT SIZE	HEATING VELOCITY (ft/min)	COOLING VELOCITY (ft/min)	OUTLET GRILL SIZE	TRUNK
1	MBR	0.86	20	1.46	47	0.17	35	150	185	0.09	5	147	345	3X10	C
2	ENS	1.64	38	1.14	37	0.17	43	200	243	0.07	4	436	424	3X10	D
3	BED-2	1.15	27	1.58	51	0.17	57	180	237	0.07	5	198	374	3X10	A
4	BED-2	1.15	27	1.58	51	0.17	60	120	180	0.1	5	198	374	3X10	B
5	BED-3	1.84	43	1.92	62	0.17	64	180	244	0.07	6	219	316	4X10	A
6	BED-4	1.17	27	1.52	49	0.17	35	140	175	0.1	6	138	250	4X10	D
7	BATH	0.84	20	0.51	17	0.17	42	150	192	0.09	4	229	195	3X10	D
8	BED-3	1.84	43	1.92	62	0.17	54	160	214	0.08	6	219	316	4X10	A
9	LIB	1.59	37	1.50	49	0.17	52	130	182	0.09	5	272	360	3X10	A
10	MBR	0.86	20	1.46	47	0.17	36	160	196	0.09	5	147	345	3X10	C
11	ENS-3	1.25	29	0.94	30	0.17	37	150	187	0.09	4	333	344	3X10	B
12	LIB	1.59	37	1.50	49	0.17	44	130	174	0.1	5	272	360	3X10	A
13	DIN	2.32	54	1.87	61	0.17	27	140	167	0.1	5	396	448	3X10	B
14	KT/FM	1.71	40	2.11	69	0.17	27	80	107	0.16	5	294	507	3X10	D
15	KT/FM	1.71	40	2.11	69	0.17	29	130	159	0.11	5	294	507	3X10	C
16	KT/FM	1.71	40	2.11	69	0.17	21	110	131	0.13	5	294	507	3X10	C
17	LAUN	0.21	5	0.74	24	0.17	46	130	176	0.1	4	57	275	3X10	B
18	PWD	0.69	16	0.52	17	0.17	39	110	149	0.12	4	184	195	3X10	B
19	FOY	2.86	67	0.64	21	0.17	26	140	166	0.1	5	492	154	3X10	B
21	BAS	4.27	100	0.50	16	0.16	29	130	159	0.1	6	510	82	4X10	C
22	BAS	4.27	100	0.50	16	0.16	16	120	136	0.12	6	510	82	4X10	D
23	BAS	4.27	100	0.50	16	0.16	39	140	179	0.09	6	510	82	4X10	A

SUPPLY AIR TRUNK SIZE	TRUNK CFM	STATIC PRESS.	ROUND DUCT	RECT DUCT	VELOCITY (ft/min)	TRUNK CFM	STATIC PRESS.	ROUND DUCT	RECT DUCT	VELOCITY (ft/min)	RETURN AIR TRUNK SIZE	TRUNK CFM	STATIC PRESS.	ROUND DUCT	RECT DUCT	VELOCITY (ft/min)
TRUNK A	287	0.07	9.1	10	517	TRUNK G	0	0.00	0	0	TRUNK O	0	0.05	0	0	8
TRUNK B	485	0.07	11.1	14	624	TRUNK H	0	0.00	0	0	TRUNK P	0	0.05	0	0	8
TRUNK C	220	0.09	7.7	8	495	TRUNK I	0	0.00	0	0	TRUNK Q	0	0.05	0	0	8
TRUNK D	445	0.07	10.7	14	572	TRUNK J	0	0.00	0	0	TRUNK R	0	0.05	0	0	8
TRUNK E	0	0.00	0	0	0	TRUNK K	0	0.00	0	0	TRUNK S	0	0.05	0	0	8
TRUNK F	0	0.00	0	0	0	TRUNK L	0	0.00	0	0	TRUNK T	0	0.05	0	0	8
RETURN AIR #	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
AIR VOLUME	135	95	85	75	75	360	0	0	0	0	0	0	0	0	0	103
PLENUM PRESSURE	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15
ACTUAL DUCT LGH.	45	36	64	68	69	38	1	1	1	1	1	1	1	1	1	14
EQUIVALENT LENGTH	175	140	195	235	240	150	0	0	0	0	0	0	0	0	0	180
TOTAL EFFECTIVE LH	220	176	259	303	309	188	1	1	1	1	1	1	1	1	1	194
ADJUSTED PRESSURE	0.07	0.08	0.06	0.05	0.05	0.08	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	0.08
ROUND DUCT SIZE	6.8	5.8	6	6	6	9.6	0	0	0	0	0	0	0	0	0	6
INLET GRILL SIZE	8	8	8	8	8	8	0	0	0	0	0	0	0	0	0	8
INLET GRILL SIZE	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
INLET GRILL SIZE	14	14	14	14	14	30	0	0	0	0	0	0	0	0	0	14

TYPE: CHERRY 12
SITE NAME: BARLASSINA

LO # 98652

RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY

COMBUSTION APPLIANCES		9.32.3.1(1)
a)	☒ Direct vent (sealed combustion) only	
b)	☐ Positive venting induced draft (except fireplaces)	
c)	☐ Natural draft, B-vent or induced draft gas fireplace	
d)	☐ Solid Fuel (including fireplaces)	
e)	☐ No Combustion Appliances	

HEATING SYSTEM	
☒ Forced Air	☐ Non Forced Air
☐ Electric Space Heat	

HOUSE TYPE		9.32.1(2)
☒ I	Type a) or b) appliance only, no solid fuel	
☐ II	Type I except with solid fuel (including fireplaces)	
☐ III	Any Type c) appliance	
☐ IV	Type I, or II with electric space heat	
☐	Other: Type I, II or IV no forced air	

SYSTEM DESIGN OPTIONS		O.N.H.W.P.
☐	1 Exhaust only/Forced Air System	
☐	2 HRV with Ducting/Forced Air System	
☒	3 HRV Simplified/connected to forced air system	
☐	4 HRV with Ducting/non forced air system	
☐	Part 6 Design	

TOTAL VENTILATION CAPACITY		9.32.3.3(1)
Basement + Master Bedroom	2 @ 21.2 cfm	42.4 cfm
Other Bedrooms	3 @ 10.6 cfm	31.8 cfm
Kitchen & Bathrooms	5 @ 10.6 cfm	53 cfm
Other Rooms	5 @ 10.6 cfm	53.0 cfm
Table 9.32.3.A.	TOTAL	180.2 cfm

PRINCIPAL VENTILATION CAPACITY REQUIRED		9.32.3.4.(1)
1 Bedroom	31.8	cfm
2 Bedroom	47.7	cfm
3 Bedroom	63.6	cfm
4 Bedroom	79.5	cfm
5 Bedroom	95.4	cfm
TOTAL		79.5 cfm

SUPPLEMENTAL VENTILATION CAPACITY		9.32.3.5.
Total Ventilation Capacity	180.2	cfm
Less Principal Ventil. Capacity	79.5	cfm
Required Supplemental Capacity	100.7	cfm

PRINCIPAL EXHAUST FAN CAPACITY	
Model:	VANEE V150H
Location:	BSMT
79.5 cfm	☒ HVI Approved

PRINCIPAL EXHAUST HEAT LOSS CALCULATION				
CFM	ΔT °F	FACTOR	% LOSS	
79.5 CFM	X 72 F	X 1.08	X	0.25

SUPPLEMENTAL FANS BY INSTALLING CONTRACTOR				
Location	Model	cfm	HVI	Sones
ENS	BY INSTALLING CONTRACTOR	50	☒	3.5
BATH	BY INSTALLING CONTRACTOR	50	☒	3.5
ENS-3	BY INSTALLING CONTRACTOR	50	☒	3.5
PWD	BY INSTALLING CONTRACTOR	50	☒	3.5

HEAT RECOVERY VENTILATOR		9.32.3.11.
Model:	VANEE V150H	
150 cfm high	35 cfm low	
75 % Sensible Efficiency	☒ HVI Approved	
@ 32 deg F (0 deg C)		

LOCATION OF INSTALLATION	
Lot:	Concession
Township	Plan:
Address	
Roll #	Building Permit #

BUILDER: GREENPARK HOMES	
Name:	
Address:	
City:	
Telephone #:	Fax #:

INSTALLING CONTRACTOR	
Name:	
Address:	
City:	
Telephone #:	Fax #:

DESIGNER CERTIFICATION	
I hereby certify that this ventilation system has been designed in accordance with the Ontario Building Code.	
Name:	HVAC Designs Ltd.
Signature:	<i>Michael O'Rourke</i>
HRAI #	001820
Date:	August-22

CSA F280-12 Residential Heat Loss and Heat Gain Calculations																																																												
Formula Sheet (For Air Leakage / Ventilation Calculation)																																																												
LO#: 98652		Model: CHERRY 12		Date: 2022-08-30																																																								
Builder: GREENPARK HOMES																																																												
Volume Calculation			Air Change & Delta T Data																																																									
House Volume <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>Level</th> <th>Floor Area (ft²)</th> <th>Floor Height (ft)</th> <th>Volume (ft³)</th> </tr> </thead> <tbody> <tr> <td>Bsmt</td> <td>1054</td> <td>9</td> <td>9486</td> </tr> <tr> <td>First</td> <td>1054</td> <td>10</td> <td>10540</td> </tr> <tr> <td>Second</td> <td>1300</td> <td>9</td> <td>11700</td> </tr> <tr> <td>Third</td> <td>0</td> <td>9</td> <td>0</td> </tr> <tr> <td>Fourth</td> <td>0</td> <td>9</td> <td>0</td> </tr> <tr> <td colspan="3" style="text-align: right;">Total:</td> <td>31,726.0 ft³</td> </tr> <tr> <td colspan="3" style="text-align: right;">Total:</td> <td>898.4 m³</td> </tr> </tbody> </table>			Level	Floor Area (ft ²)	Floor Height (ft)	Volume (ft ³)	Bsmt	1054	9	9486	First	1054	10	10540	Second	1300	9	11700	Third	0	9	0	Fourth	0	9	0	Total:			31,726.0 ft ³	Total:			898.4 m ³	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 80%;">WINTER NATURAL AIR CHANGE RATE</td> <td style="width: 20%;">0.319</td> </tr> <tr> <td>SUMMER NATURAL AIR CHANGE RATE</td> <td>0.085</td> </tr> </table> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th colspan="5" style="text-align: center;">Design Temperature Difference</th> </tr> <tr> <th></th> <th>Tin °C</th> <th>Tout °C</th> <th>ΔT °C</th> <th>ΔT °F</th> </tr> <tr> <td>Winter DTDh</td> <td>22</td> <td>-18</td> <td>40</td> <td>72</td> </tr> <tr> <td>Summer DTDc</td> <td>24</td> <td>29</td> <td>5</td> <td>9</td> </tr> </table>		WINTER NATURAL AIR CHANGE RATE	0.319	SUMMER NATURAL AIR CHANGE RATE	0.085	Design Temperature Difference						Tin °C	Tout °C	ΔT °C	ΔT °F	Winter DTDh	22	-18	40	72	Summer DTDc	24	29	5	9
Level	Floor Area (ft ²)	Floor Height (ft)	Volume (ft ³)																																																									
Bsmt	1054	9	9486																																																									
First	1054	10	10540																																																									
Second	1300	9	11700																																																									
Third	0	9	0																																																									
Fourth	0	9	0																																																									
Total:			31,726.0 ft ³																																																									
Total:			898.4 m ³																																																									
WINTER NATURAL AIR CHANGE RATE	0.319																																																											
SUMMER NATURAL AIR CHANGE RATE	0.085																																																											
Design Temperature Difference																																																												
	Tin °C	Tout °C	ΔT °C	ΔT °F																																																								
Winter DTDh	22	-18	40	72																																																								
Summer DTDc	24	29	5	9																																																								
5.2.3.1 Heat Loss due to Air Leakage			6.2.6 Sensible Gain due to Air Leakage																																																									
$HL_{airb} = LR_{airh} \times \frac{V_b}{3.6} \times DTD_h \times 1.2$ 0.319 x 249.55 x 40 °C x 1.2 = 3847 W = 13127 Btu/h			$HG_{salb} = LR_{airc} \times \frac{V_b}{3.6} \times DTD_c \times 1.2$ = 0.085 x 249.55 x 5 °C x 1.2 = 129 W = 442 Btu/h																																																									
5.2.3.2 Heat Loss due to Mechanical Ventilation			6.2.7 Sensible heat Gain due to Ventilation																																																									
$HL_{vairb} = PVC \times DTD_h \times 1.08 \times (1 - E)$ 80 CFM x 72 °F x 1.08 x 0.25 = 1554 Btu/h			$HL_{vairb} = PVC \times DTD_h \times 1.08 \times (1 - E)$ 80 CFM x 9 °F x 1.08 x 0.25 = 197 Btu/h																																																									
5.2.3.3 Calculation of Air Change Heat Loss for Each Room (Floor Multiplier Section)																																																												
$HL_{airr} = Level\ Factor \times HL_{airbv} \times \{(HL_{agcr} + HL_{bgcr}) \div (HL_{agclevel} + HL_{bgclevel})\}$ <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>Level</th> <th>Level Factor (LF)</th> <th>HLairbv Air Leakage + Ventilation Heat Loss (Btu/h)</th> <th>Level Conductive Heat Loss: (HL_{clevel})</th> <th>Air Leakage Heat Loss Multiplier (LF x HLairbv / HL_{clevel})</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>0.5</td> <td rowspan="5" style="text-align: center;">13,127</td> <td>6,251</td> <td>1.050</td> </tr> <tr> <td>2</td> <td>0.3</td> <td>10,228</td> <td>0.385</td> </tr> <tr> <td>3</td> <td>0.2</td> <td>9,625</td> <td>0.273</td> </tr> <tr> <td>4</td> <td>0</td> <td>0</td> <td>0.000</td> </tr> <tr> <td>5</td> <td>0</td> <td>0</td> <td>0.000</td> </tr> </tbody> </table>					Level	Level Factor (LF)	HLairbv Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{clevel})	Air Leakage Heat Loss Multiplier (LF x HLairbv / HL _{clevel})	1	0.5	13,127	6,251	1.050	2	0.3	10,228	0.385	3	0.2	9,625	0.273	4	0	0	0.000	5	0	0	0.000																														
Level	Level Factor (LF)	HLairbv Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{clevel})	Air Leakage Heat Loss Multiplier (LF x HLairbv / HL _{clevel})																																																								
1	0.5	13,127	6,251	1.050																																																								
2	0.3		10,228	0.385																																																								
3	0.2		9,625	0.273																																																								
4	0		0	0.000																																																								
5	0		0	0.000																																																								
*HLairbv = Air leakage heat loss + ventilation heat loss *For a balanced or supply only ventilation system HLairv = 0																																																												

Michael O'Rourke
BCIN# 19669

Michael O'Rourke

HEAT LOSS AND GAIN SUMMARY SHEET**MODEL:** CHERRY 12**BUILDER:** GREENPARK HOMES**SFQT:** 2354**LO#** 98652**SITE:** BARLASSINA**DESIGN ASSUMPTIONS**

HEATING	°F	COOLING	°F
OUTDOOR DESIGN TEMP.	0	OUTDOOR DESIGN TEMP.	84
INDOOR DESIGN TEMP.	72	INDOOR DESIGN TEMP. (MAX 75°F)	75
		WINDOW SHGC	0.50

BUILDING DATA

ATTACHMENT:	ATTACHED	# OF STORIES (+BASEMENT):	3
FRONT FACES:	EAST	ASSUMED (Y/N):	Y
AIR CHANGES PER HOUR:	3.57	ASSUMED (Y/N):	Y
AIR TIGHTNESS CATEGORY:	AVERAGE	ASSUMED (Y/N):	Y
WIND EXPOSURE:	SHELTERED	ASSUMED (Y/N):	Y
HOUSE VOLUME (ft³):	31726.0	ASSUMED (Y/N):	Y
INTERNAL SHADING:	BLINDS/CURTAINS	ASSUMED OCCUPANTS:	5
INTERIOR LIGHTING LOAD (Btu/h/ft²):	1.27	DC BRUSHLESS MOTOR (Y/N):	Y
FOUNDATION CONFIGURATION	BCIN_1	DEPTH BELOW GRADE:	6.0 ft
LENGTH: 57.0 ft	WIDTH: 25.0 ft	EXPOSED PERIMETER:	132.0 ft

2012 OBC - COMPLIANCE PACKAGE**Component**


NOT THE GRANTING OF A PERMIT NOR REVIEWING OF SPECS
& DRAWINGS NOR INSPECTIONS MADE DURING INSTALLATION
BY THE OFFICIAL HAVING JURISDICTION SHALL RELIEVE THE
OWNER FROM REQUIREMENTS OF THE ONTARIO BUILDING
CODE AND ANY OTHER REFERENCED REQUIREMENTS.

Compliance Package**A1****Nominal Min. Eff.**

Ceiling with Attic Space Minimum RSI (R)-Value	60	59.22
Ceiling Without Attic Space Minimum RSI (R)-Value	31	27.65
Exposed Floor Minimum RSI (R)-Value	31	29.80
Walls Above Grade Minimum RSI (R)-Value	22	17.03
Basement Walls Minimum RSI (R)-Value	20 ci	21.12
Below Grade Slab Entire surface > 600 mm below grade Minimum RSI (R)-Value	-	-
Edge of Below Grade Slab ≤ 600 mm Below Grade Minimum RSI (R)-Value	10	10
Heated Slab or Slab ≤ 600 mm below grade Minimum RSI (R)-Value	10	11.13
Windows and Sliding Glass Doors Maximum U-Value	0.28	-
Skylights Maximum U-Value	0.49	-
Space Heating Equipment Minimum AFUE	96%	-
HRV/ERV Minimum Efficiency	75%	-
Domestic Hot Water Heater Minimum EF	0.8	-

INDIVIDUAL BCIN: 19669


MICHAEL O'ROURKE



NOT THE GRANTING OF A PERMIT NOR REVIEWING OF SPECS
& DRAWINGS NOR INSPECTIONS MADE DURING INSTALLATION
BY THE OFFICIAL HAVING JURISDICTION SHALL RELIEVE THE
OWNER FROM REQUIREMENTS OF THE ONTARIO BUILDING
CODE AND ANY OTHER REFERENCED REQUIREMENTS.

Residential Foundation Thermal Load Calculator

Supplemental tool for CAN/CSA-F280

Weather Station Description		
Province:	Ontario	
Region:	Cambridge	
Site Description		
Soil Conductivity:	Normal conductivity: dry sand, loam, clay	
Water Table:	Normal (7-10 m, 23-33 ft)	
Foundation Dimensions		
Floor Length (m):	17.4	 Insulation Configuration
Floor Width (m):	7.6	
Exposed Perimeter (m):	40.2	
Wall Height (m):	2.7	
Depth Below Grade (m):	1.83	
Window Area (m ²):	1.1	
Door Area (m ²):	1.9	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	33	
Design Months		
Heating Month	1	
Foundation Loads		
Heating Load (Watts):	1250	

TYPE: CHERRY 12
LO# 98652

NOT THE GRANTING OF A PERMIT NOR REVIEWING OF SPECS
& DRAWINGS NOR INSPECTIONS MADE DURING INSTALLATION
BY THE OFFICIAL HAVING JURISDICTION SHALL RELIEVE THE
OWNER FROM REQUIREMENTS OF THE ONTARIO BUILDING
CODE AND ANY OTHER REFERENCED REQUIREMENTS.

Air Infiltration Residential Load Calculator

Supplemental tool for CAN/CSA-F280

Weather Station Description				
Province:	Ontario			
Region:	Cambridge			
Weather Station Location:	Open flat terrain, grass			
Anemometer height (m):	10			
Local Shielding				
Building Site:	Suburban, forest			
Walls:	Heavy			
Flue:	Heavy			
Highest Ceiling Height (m):	6.71			
Building Configuration				
Type:	Semi			
Number of Stories:	Two			
Foundation:	Full			
House Volume (m ³):	898.4			
Air Leakage/Ventilation				
Air Tightness Type:	Present (1961-) (3.57 ACH)			
Custom BDT Data:	ELA @ 10 Pa.	1197.6 cm ²		
	3.57	ACH @ 50 Pa		
Mechanical Ventilation (L/s):	Total Supply	Total Exhaust		
	37.5	37.5		
Flue Size				
Flue #:	#1	#2	#3	#4
Diameter (mm):	0	0	0	0
Natural Infiltration Rates				
Heating Air Leakage Rate (ACH/H):	0.319			
Cooling Air Leakage Rate (ACH/H):	0.085			


TYPE: CHERRY 12

LO# 98652

Michael O'Rourke BCIN# 19669




OPTIONAL
COLDCELLAR

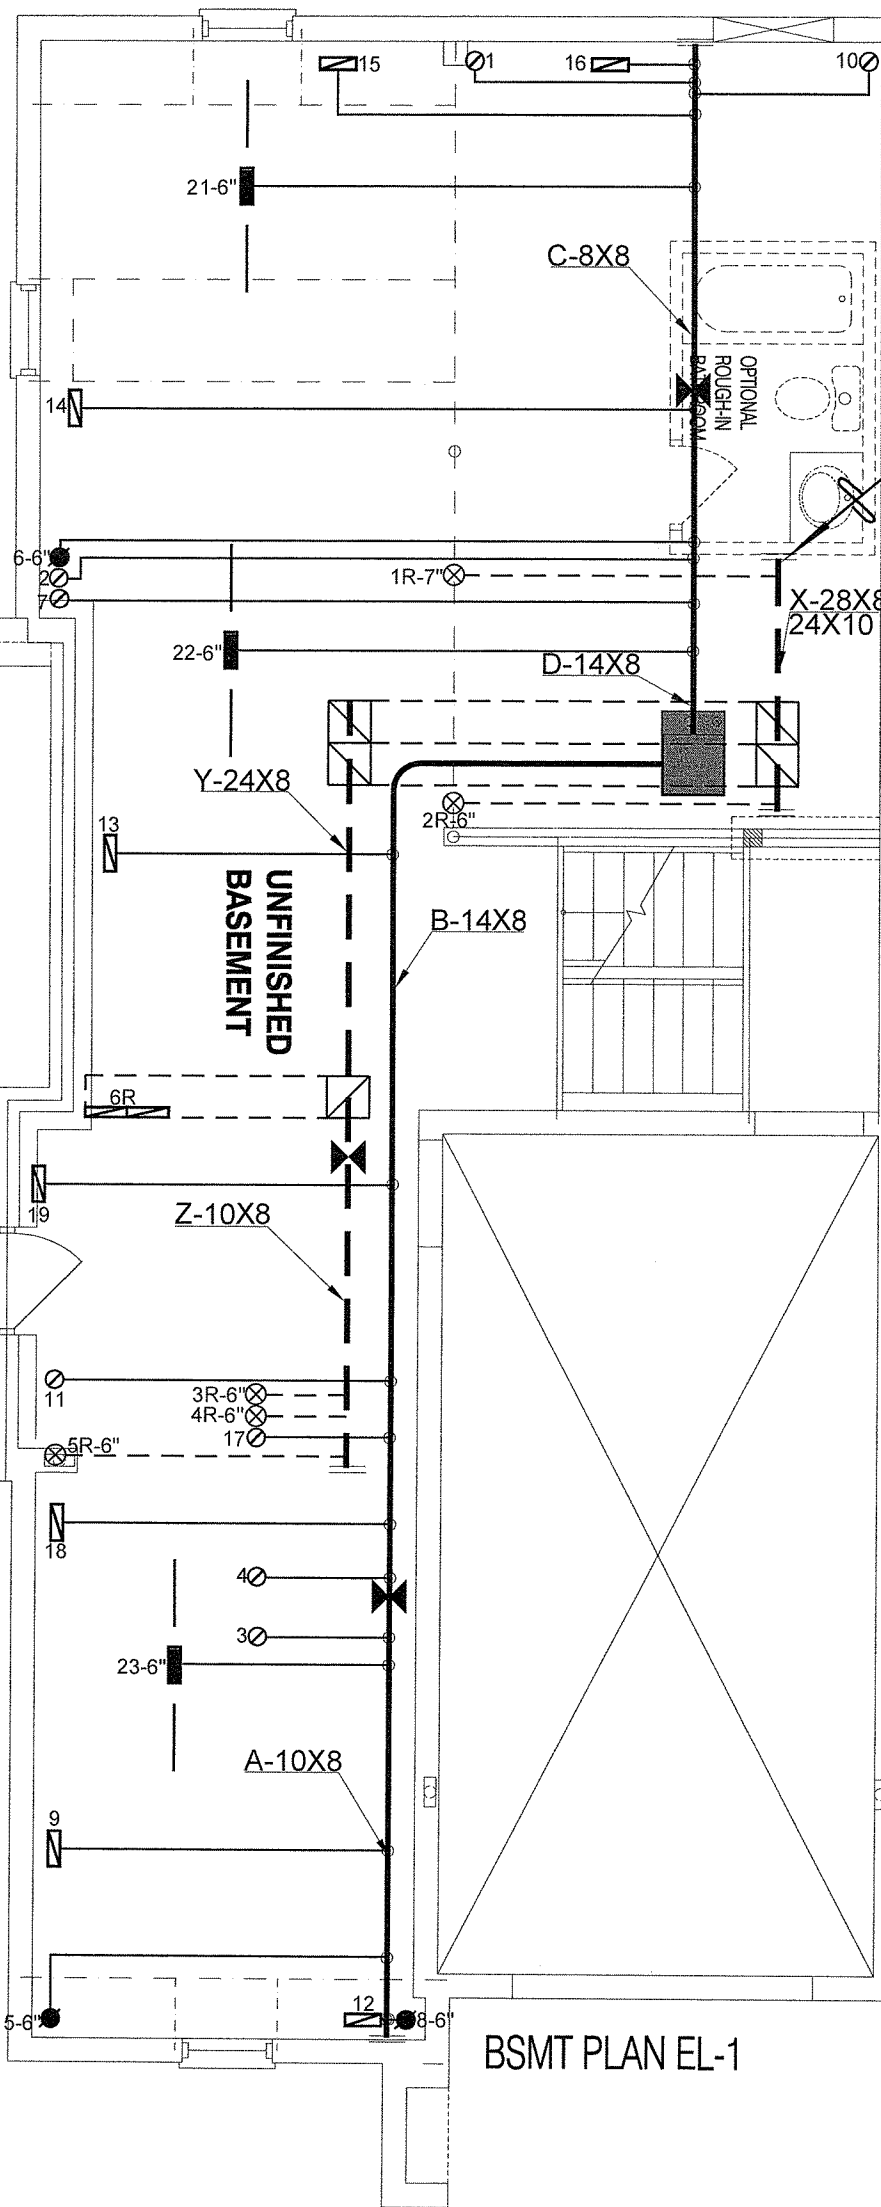


BSMT PLAN EL-1

OPTIONAL
COLDCELLAR

BR-6\"
C/W DAMPER

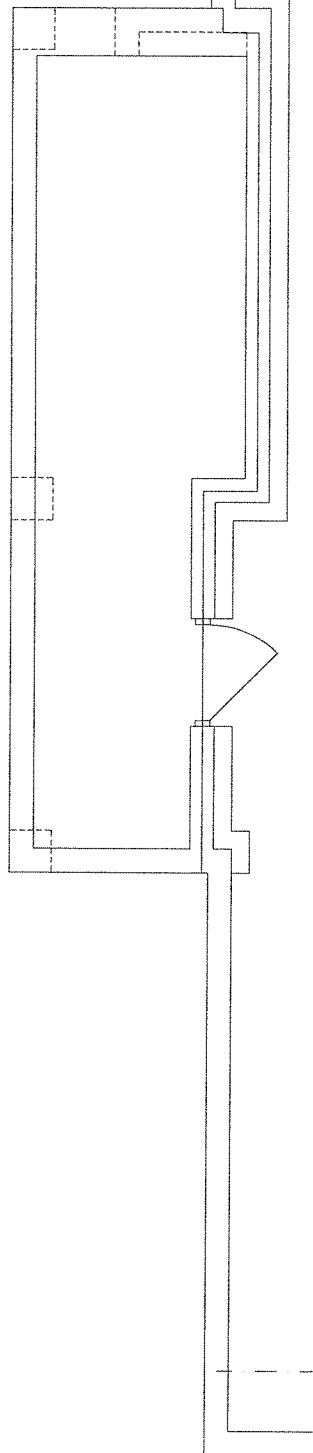

BSMT PLAN EL-2

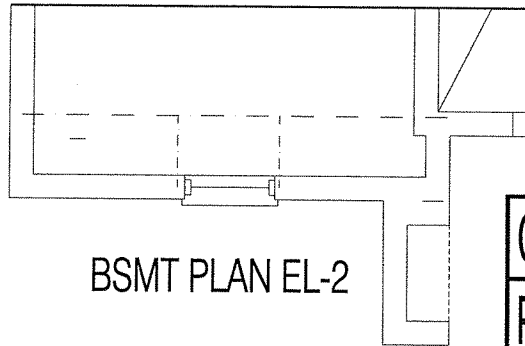

BSMT PLAN EL-2

I MICHAEL O'ROURKE HAVE REVIEWED AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C. 3.2.5 OF THE BUILDING CODE.
Michael O'Rourke
Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.

NOT THE GRANTING OF A PERMIT NOR REVIEWING OF SPECS & DRAWINGS NOR INSPECTIONS MADE DURING INSTALLATION BY THE OFFICIAL HAVING JURISDICTION SHALL RELIEVE THE OWNER FROM REQUIREMENTS OF THE ONTARIO BUILDING CODE AND ANY OTHER REFERENCED REQUIREMENTS.

CSA-F280-12
PACKAGE A1

HVAC LEGEND								3.		
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.		
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.		
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description	Date
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	REVISIONS		


ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client
GREENPARK HOMES
Project Name
**BARLASSINA
CAMBRIDGE, ONTARIO**
Block 121 Units 1 to 6
CHERRY 12 **2354 sqft**


HVACDESIGNS LTD.
375 Finley Ave. Suite 202 - Ajax, Ontario
L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375
Email: info@hvacdesigns.ca
Web: www.hvacdesigns.ca
Specializing in Residential Mechanical Design Services
Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.

HEAT LOSS 41347 BTU/H UNIT DATA		# OF RUNS S/A R/A FANS			
MAKE	GOODMAN	3RD FLOOR			
MODEL	GMEC960603BNA	2ND FLOOR	11	5	4
INPUT	60 MBTU/H	1ST FLOOR	8	1	2
OUTPUT	57.6 MBTU/H	BASEMENT	3	1	0
COOLING	2.5 TONS	ALL S/A DIFFUSERS 4 "x10" UNLESS NOTED OTHERWISE ON LAYOUT. ALL S/A RUNS 5'Ø UNLESS NOTED OTHERWISE ON LAYOUT. UNDERCUT DOORS 1" min. FOR R/A			
FAN SPEED	928 cfm @ 0.6" w.c.				


Sheet Title
**BASEMENT
HEATING
LAYOUT**
Date
AUG/2022
Scale
3/16" = 1'-0"
BCIN# 19669
LO# 98652

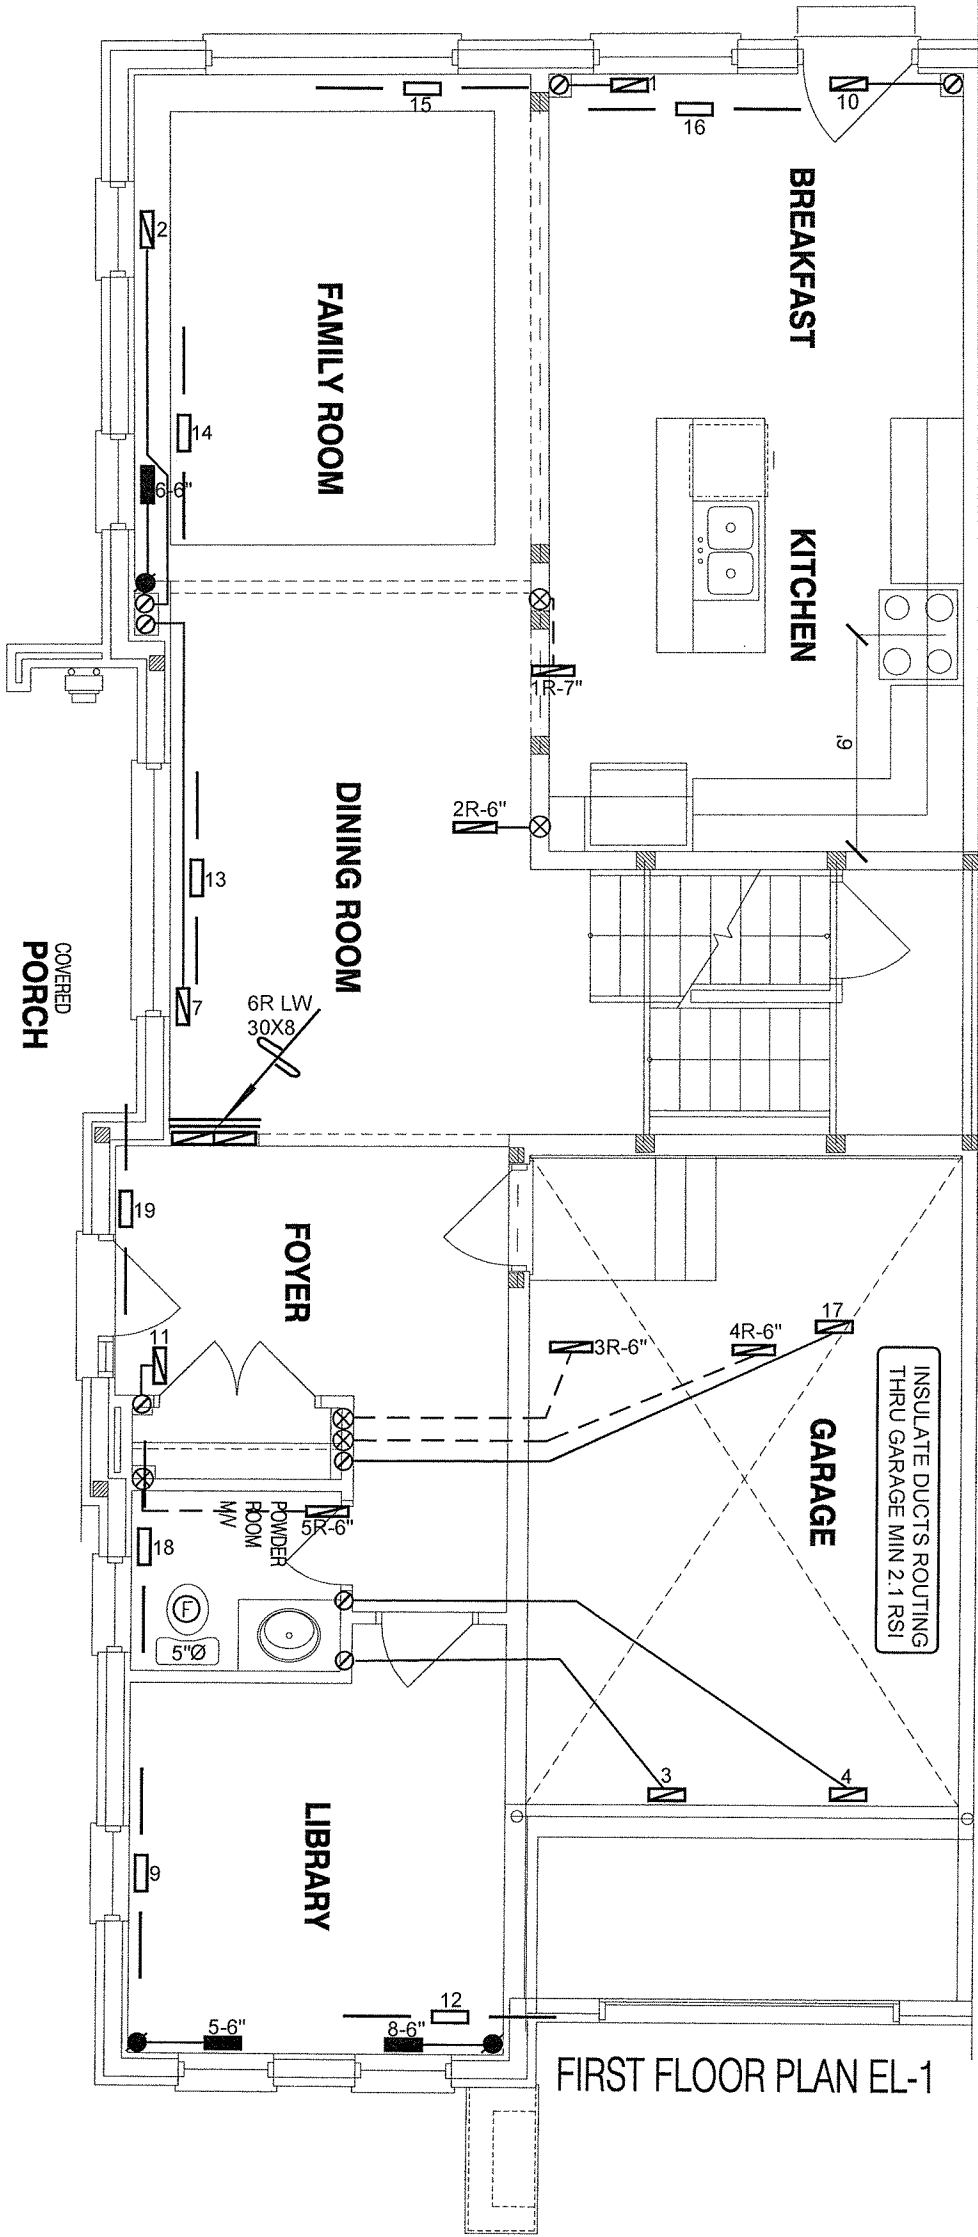

FIRST FLOOR PLAN EL-1

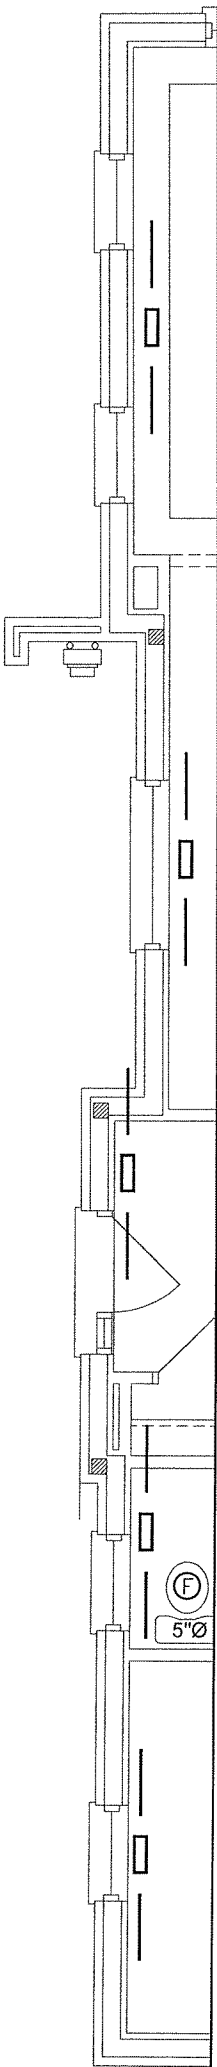

FIRST FLOOR PLAN EL-2

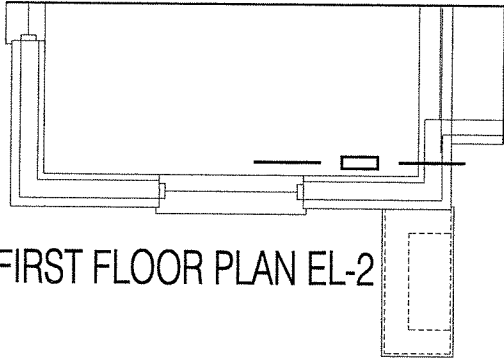

FIRST FLOOR PLAN EL-2

I MICHAEL O'ROURKE HAVE REVIEWED AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C, 3.2.3 OF THE BUILDING CODE.

Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.

NOT THE GRANTING OF A PERMIT NOR REVIEWING OF SPECS & DRAWINGS NOR INSPECTIONS MADE DURING INSTALLATION BY THE OFFICIAL HAVING JURISDICTION SHALL RELIEVE THE OWNER FROM REQUIREMENTS OF THE ONTARIO BUILDING CODE AND ANY OTHER REFERENCED REQUIREMENTS.

CSA-F280-12
PACKAGE A1

HVAC LEGEND								3.		
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.		
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.		
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description	Date
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	REVISIONS		

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client
GREENPARK HOMES

Project Name
**BARLASSINA
CAMBRIDGE, ONTARIO**

Block 121 Units 1 to 6

CHERRY 12 **2354 sqft**

HVACDESIGNS LTD.

375 Finley Ave. Suite 202 - Ajax, Ontario
L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375
Email: info@hvacdsgns.ca
Web: www.hvacdesigns.ca

Specializing in Residential Mechanical Design Services

Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.


Sheet Title
**FIRST FLOOR
HEATING
LAYOUT**

Date **AUG/2022**


Scale **3/16" = 1'-0"**

BCIN# 19669


LO# 98652

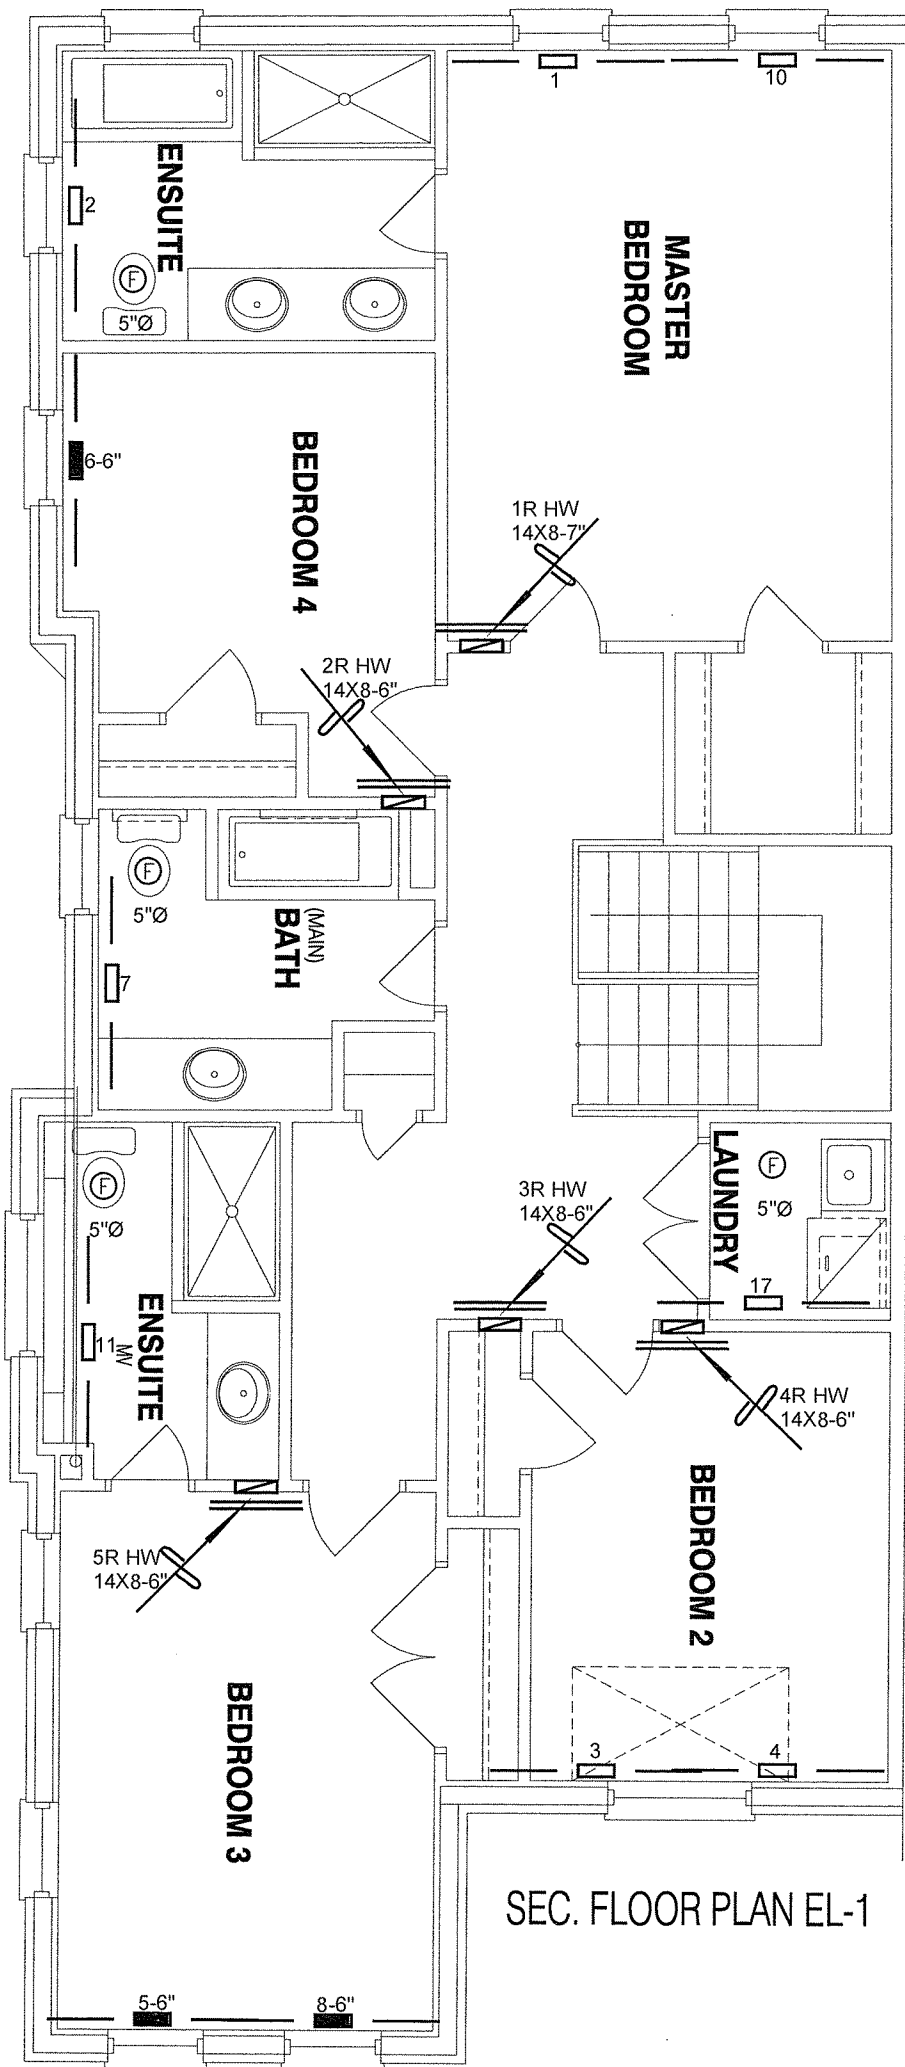

SEC. FLOOR PLAN EL-1

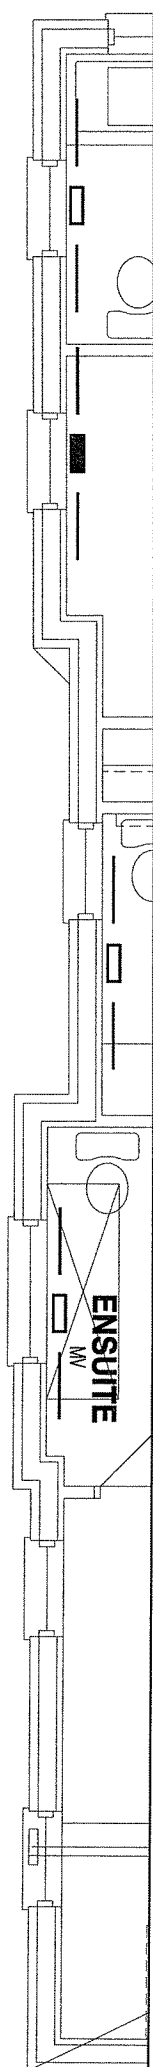

SEC. FLOOR PLAN EL-2

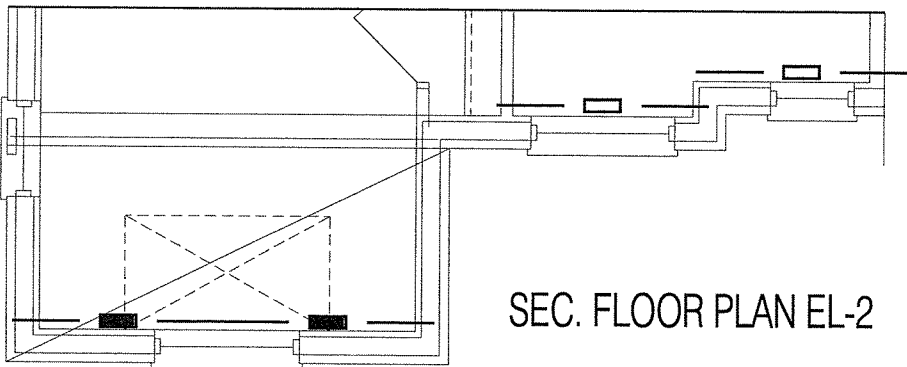

SEC. FLOOR PLAN EL-2

CSA-F280-12
PACKAGE A1

I MICHAEL O'ROURKE HAVE REVIEWED AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C, 3.2.5 OF THE BUILDING CODE.
Michael O'Rourke
Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.

NOT THE GRANTING OF A PERMIT NOR REVIEWING OF SPECS & DRAWINGS NOR INSPECTIONS MADE DURING INSTALLATION BY THE OFFICIAL HAVING JURISDICTION SHALL RELIEVE THE OWNER FROM REQUIREMENTS OF THE ONTARIO BUILDING CODE AND ANY OTHER REFERENCED REQUIREMENTS.

HVAC LEGEND								3.		
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.		
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.		
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description	Date
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	REVISIONS		

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client		 375 Finley Ave, Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdesigns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.	Sheet Title	
GREENPARK HOMES			SECOND FLOOR HEATING LAYOUT	
Project Name			Date	AUG/2022
BARLASSINA CAMBRIDGE, ONTARIO			Scale	3/16" = 1'-0"
Block 121 Units 1 to 6			BCIN# 19669	
CHERRY 12	2354 sqft		LO#	98652