

Engineering Notes: EWP-Floors



PLEASE READ ALL NOTES PRIOR TO INSTALLATION OF THE COMPONENT

RESPONSIBILITIES

THE RESPONSIBILITY OF THE UNDERSIGNED ENGINEER IS ONLY LIMITED TO THE CALCULATION OF THIS BUILDING COMPONENT FOR THE LOADS AND CONDITIONS SHOWN ON THIS DRAWING.

THE RESPONSIBILITY OF THE UNDERSIGNED IS LIMITED TO THE VERIFICATION OF THE STRUCTURAL CAPACITY OF THE FLOOR JOISTS AND LVL BEAMS BASED ON PLACEMENT AS SHOWN ON THE LAYOUT. THE LOADS APPLIED ARE LIMITED TO THE GRAVITY EFFECTS OF THE SPECIFIED LOADS. THE STRUCTURAL INTEGRITY OF THE BUILDING AND THE EFFECT OF WIND, UPLIFT, SEISMIC, LATERAL OR OTHER FORCES, CALCULATION OF ADEQUATE SUPPORT AND ANCHORAGE OF COMPONENTS, AS WELL AS THE DIMENSIONS AND DESIGN LOADS USED TO CALCULATE COMPONENTS ARE THE RESPONSIBILITY OF THE OVERALL BUILDING DESIGNER. FLOOR JOISTS AND OSB RIM BOARD ARE DESIGNED TO CARRY UNIFORMLY DISTRIBUTED LOADS ONLY. POINT LOADS SHOULD BE TRANSFERRED THROUGH THE FLOOR CAVITY WITH TRANSFER BLOCKS. STRUCTURAL ELEMENTS SUCH AS WALLS, POSTS, CONNECTORS, AND TRANSFER BLOCKS ARE THE RESPONSIBILITY OF THE OVERALL BUILDING DESIGNER.

THE UNDERSIGNED ENGINEER DISCLAIMS ANY RESPONSIBILITY FOR DAMAGES AS A RESULT OF BEING FURNISHED FAULTY OR INCORRECT INFORMATION, SPECIFICATIONS AND/OR DESIGNS.

COMPONENT DESIGN INFORMATION

1. THIS BUILDING COMPONENT IS CERTIFIED AS AN INDIVIDUAL COMPONENT FOR THE LOADS AND CONDITIONS SHOWN ON THE CALCULATION PAGE BASED ON INFORMATION PROVIDED BY KOTT DESIGN.
2. THE BUILDING COMPONENT USED IN CONSTRUCTION MUST BE THE SAME AS INDICATED ON THE DRAWINGS.
3. UNLESS NOTED OTHERWISE ON THE LAYOUT OR BEAM CALCULATION SHEET, MEMBERS CONSISTING OF MULTIPLE PLIES MUST BE CONNECTED AS PER THE DOCUMENT "MULTIPLE MEMBER CONNECTION DETAILS" SHOWN ON PAGE 2 OF THIS DOCUMENT.
4. PASS-THRU TRANSFER BLOCK FRAMING IS REQUIRED AT ALL POINT LOADS OVER BEARINGS.
5. IT IS ASSUMED THAT EACH LVL BEAM WHERE NOT SEATED IN A HANGER IS ATTACHED USING (4) FOUR 3-1/4" COMMON SPIRAL NAILS FOR UP TO 5.5" LONG BEARINGS AND USING (6) SIX 3-1/4" COMMON SPIRAL NAILS FOR BEARINGS EQUAL TO OR LONGER THAN 5.5", UNLESS INDICATED OTHERWISE.

CODE

THIS BUILDING COMPONENT IS DESIGNED IN ACCORDANCE WITH THE NATIONAL BUILDING CODE OF CANADA, THE ONTARIO BUILDING CODE, CCMC AND CANADIAN STANDARDS ASSOCIATION GUIDELINES.

HANDLING AND INSTALLATION

1. DO NOT DRILL ANY HOLE, CUT OR NOTCH A CERTIFIED BUILDING COMPONENT WITHOUT A WRITTEN PRE-AUTHORIZATION.
2. INSTALLATION AND ASSEMBLY OF FLOOR JOISTS AND LVL BEAMS IS TO BE CARRIED OUT IN ACCORDANCE WITH THE CURRENT EDITION OF THE MANUFACTURER'S LITERATURE.

CITY OF RICHMOND HILL
BUILDING DIVISION

05/24/2023


Last Revised January 13, 2023
Per: joshua.nabua

RECEIVED



MULTIPLE MEMBER CONNECTIONS FOR BEAMS SHOWN ON KOTT LAYOUTS

MULTIPLE MEMBER CONNECTIONS FOR UNIFORMLY DISTRIBUTED TOP & SIDE LOADED LVL BEAMS SHOWN ON KOTT LAYOUTS

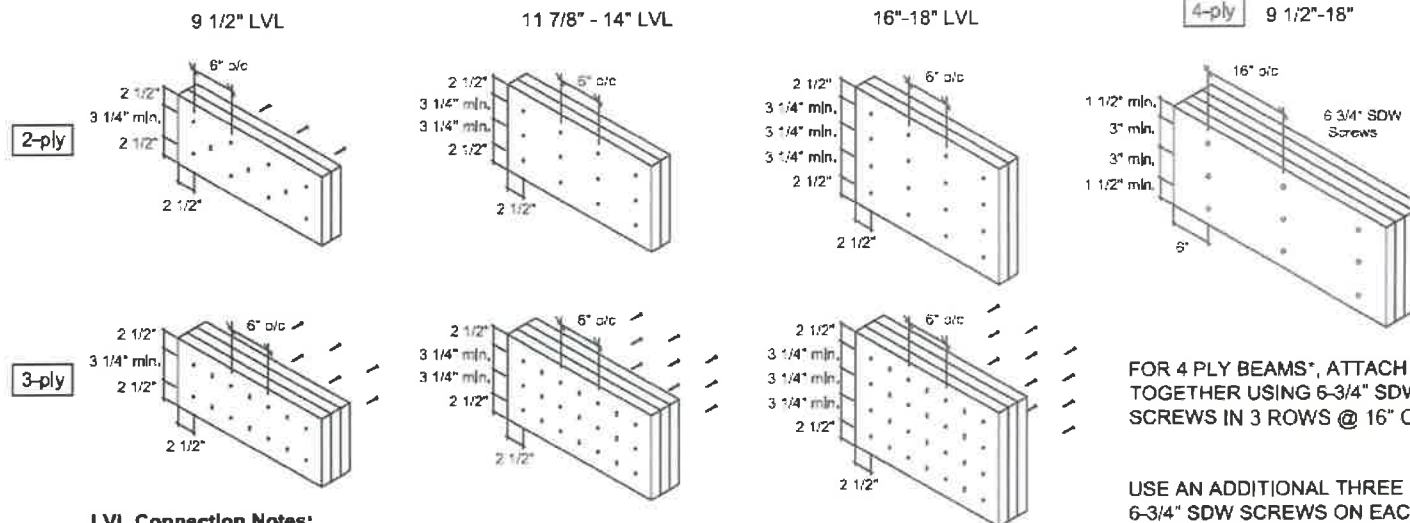

LVL Connection Notes:

- LVL ply width is 1-3/4"
- Nails to be 3 1/2" common wire nails.
- Nails to be located 2 1/2" min. from the top and bottom of the member. Start all nails 2 1/2" min. from ends.
- Minimum 3 1/4" spacing between rows.
- Number of rows and spacing as per details shown, unless noted otherwise.
- "X" represents nail driven from the opposite side.
- Head of all specified screws must be on the loaded side.

FOR 4 PLY BEAMS*, ATTACH PLIES TOGETHER USING 6-3/4" SDW SCREWS IN 3 ROWS @ 16" C/C.

USE AN ADDITIONAL THREE (3) 6-3/4" SDW SCREWS ON EACH SIDE (OF EACH FACE) AT POINT LOAD LOCATIONS @ 1/2" SPACING, WHERE APPLICABLE.

*UNLESS NOTED OTHERWISE ON LAYOUT OR CALCULATION SHEET OF BEAM IN THE FLOOR PACKAGE

FOR MULTIPLE MEMBER CONNECTION OF BOISE ALLJOISTS REFER TO THE BOISE CASCADE INSTALLATION GUIDE

Installation Guide



CITY OF RICHMOND HILL
BUILDING DIVISION


05/24/2023

Last Revised January 13, 2023

RECEIVED

Per: joshua.nabua

Ground Floor

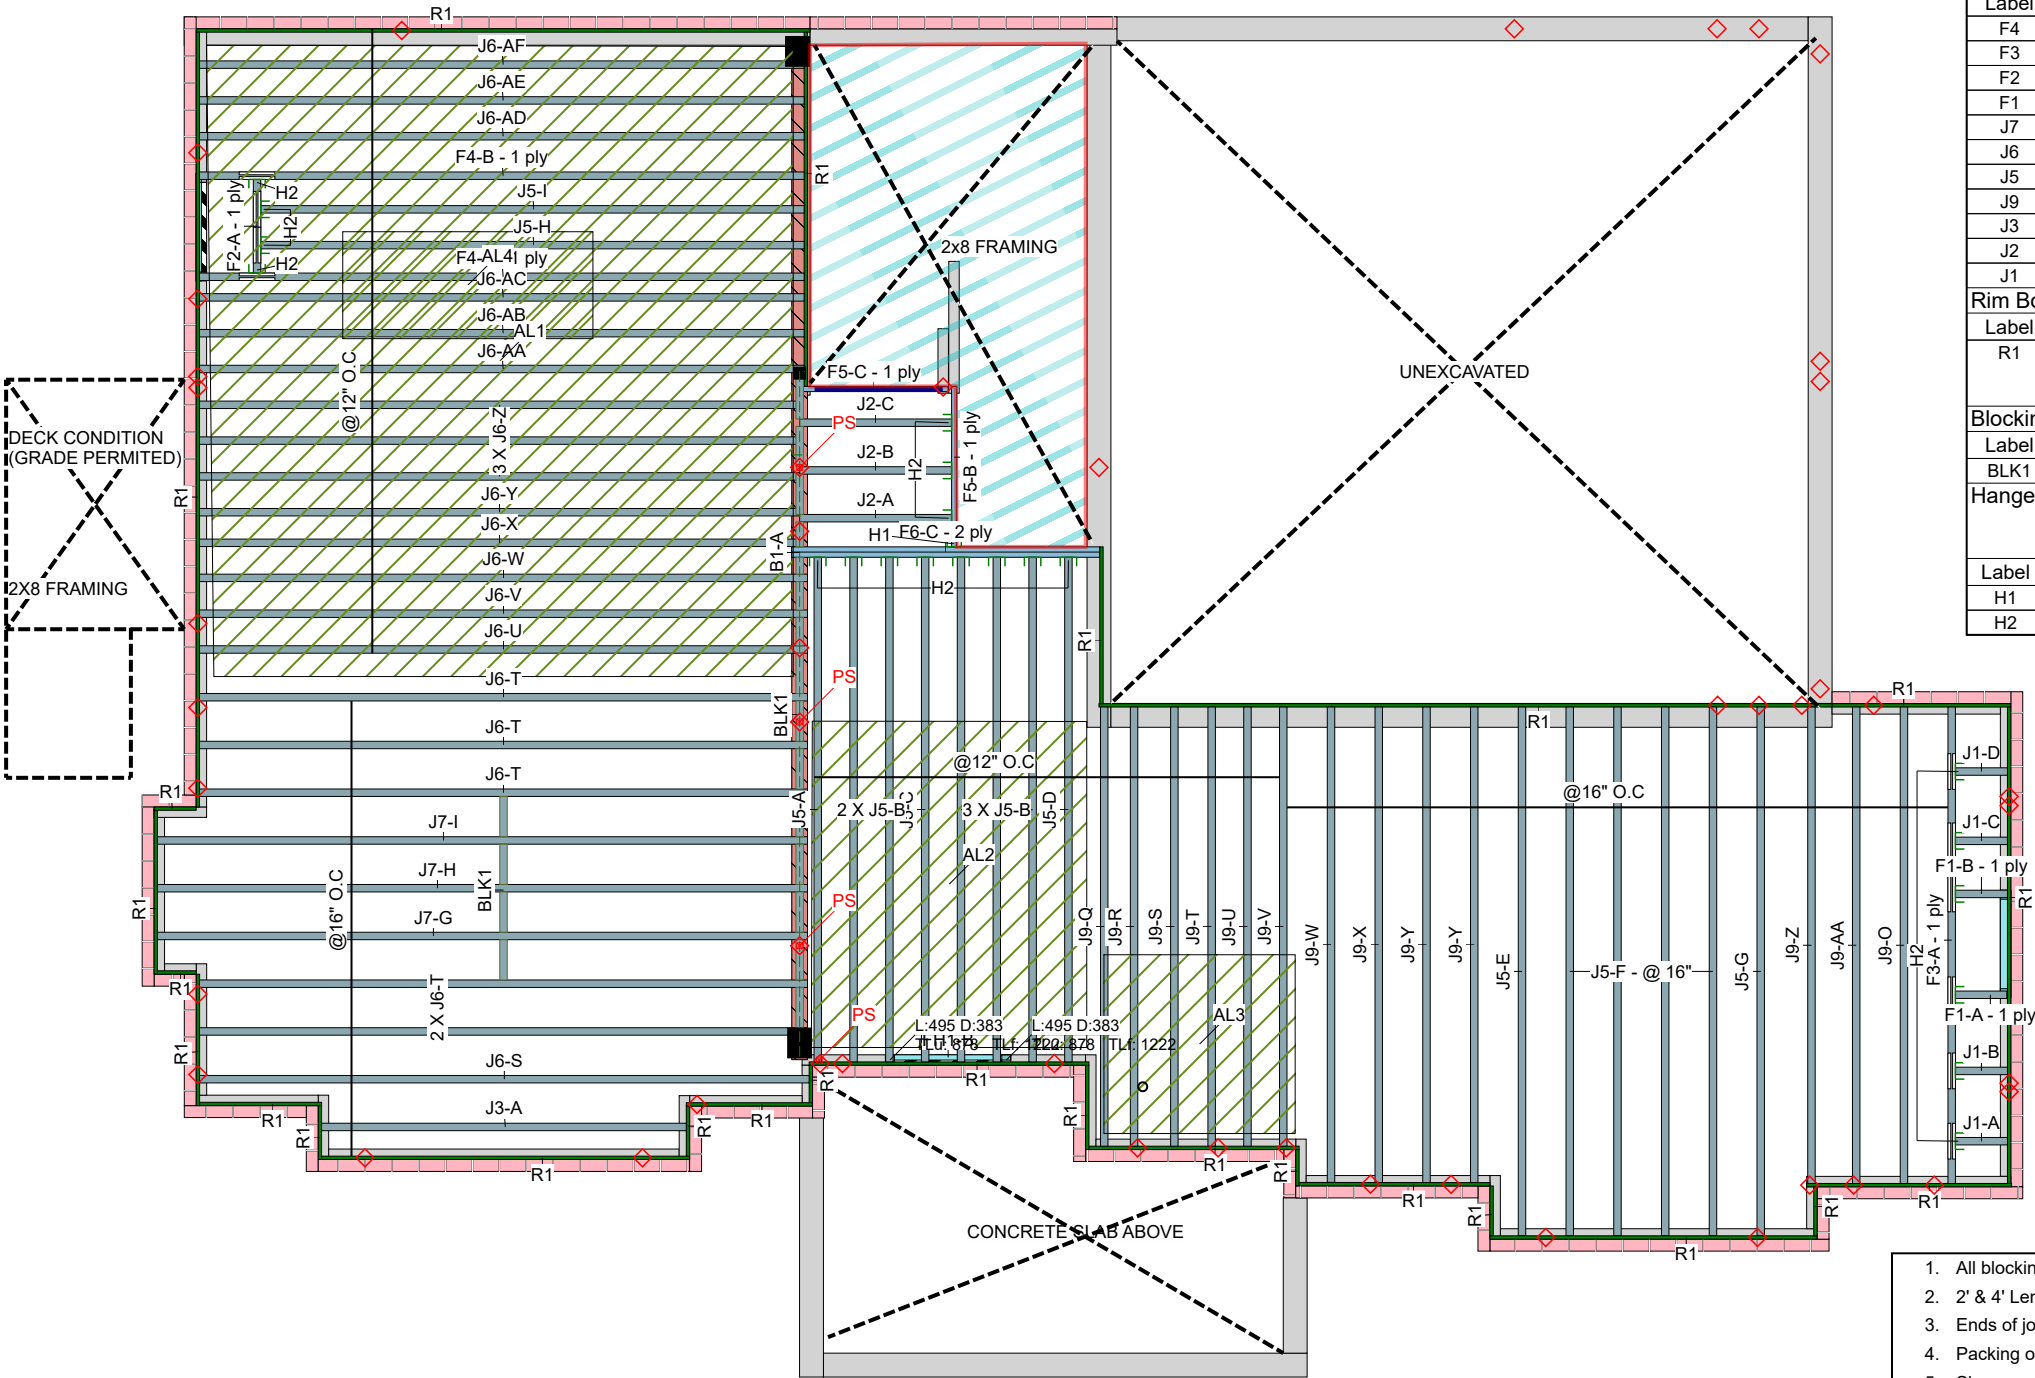

Ground Floor LVL/LSL (Flush)							
Label	Description	Width	Depth	Qty	Plies	Pcs	Length
F6	Versa-Lam LVL 2.1E 3100 SP	1.75	11.875	1	2	2	10-0-0
F5	Versa-Lam LVL 2.1E 3100 SP	1.75	11.875			2	6-0-0
I Joist (Flush)							
Label	Description	Width	Depth	Qty	Plies	Pcs	Length
F4	AJS 140	2.5	11.875			2	18-0-0
F3	AJS 140	2.5	11.875			1	14-0-0
F2	AJS 140	2.5	11.875			1	4-0-0
F1	AJS 140	2.5	11.875			2	2-0-0
J7	AJS 140	2.5	11.875			3	20-0-0
J6	AJS 140	2.5	11.875			20	18-0-0
J5	AJS 140	2.5	11.875			16	16-0-0
J9	AJS 140	2.5	11.875			13	14-0-0
J3	AJS 140	2.5	11.875			1	12-0-0
J2	AJS 140	2.5	11.875			3	6-0-0
J1	AJS 140	2.5	11.875			4	2-0-0
Rim Board							
Label	Description	Width	Depth	Qty	Plies	Pcs	Length
R1	Norbord Rimboard Plus 1.125 X 11.875	1.125	11.875			14	12-0-0
Blocking							
Label	Description	Width	Depth	Qty	Plies	Pcs	Length
BLK1	AJS 140	2.5	11.875	LinFt		Varies	20-0-0
Hanger							
				Beam/Girder		Supported Member	
Label	Pcs	Description	Skew	Slope	fasteners	fasteners	
H1	1	HUS1.81/10			30 16d	10 16d	
H2	21	LF2511			12 10dx1 1/2	1 #8x1 1/4WS	

JOB INFORMATION	
Builder	GREENPARK
Project	ROUNDEL HOMES INC
Shipping	PINETREE 11- 2 RICHMOND HILL,ON
Sales Rep	RALPH MIRIGELLO
Designer	W C
Plotted	April 10, 2023
Layout Name	PINETREE 11-2 STD & DC
Job Path	S:\CUSTOMERS\GREENPARK\ROUNDEL HOMES INC\MODELS\PINETREE 11\PINETREE 11-ELEV 2F-PT11-2\PINETREE 11-2 STD & DC.isl

DESIGN CRITERIA	
Ground Floor	
Design Method	LSD (Canada)
Building Code	NBCC 2015 / OBC 2012
Floor Loads	
Live	40
Dead	15
Deflection Joist	
LL Span L/	360
TL Span L/	240
Deflection Flush Girder	
LL Span L/	360
TL Span L/	240
Deflection Dropped Girder	
LL Span L/	360
TL Span L/	240
Deflection Header	
LL Span L/	360
TL Span L/	240
Decking	
Decking	OSB
Thickness	3/4"
Fastener	Nailed & Glued
CCMC References	
Boise - 12472-R , 12787-R	
LP - 12412-R, Roseburg - 13310-R	
Forex - 14056-R	

Kott Inc.
3228 Moodie Dr, Ottawa
14 Anderson Blvd, Uxbridge
Ontario

613-838-2775 /
905-642-4400

1. All blocking to be cut from 12' joists
2. 2' & 4' Lengths to be cut from 8' Length, 6' lengths to be cut from 12' Length
3. Ends of joists to be laterally supported
4. Packing of Steel beams and attachment by others
5. Shower and water closet flange locations are approximate only, consult architectural drawing for exact locations
6. Beams identified as "B" are dropped and supplied by others
7. Install 2x4 blocking @ 24" o/c under parallel non-loadbearing walls
8. Load transfer blocks to be installed under all point loads
9. Refer to Multiple Member Connection Detail for ply to ply nailing or bolting requirements
10. Hangers and Fasteners to be installed as per manufacturer
11. Framing shown on this layout may deviate from architectural drawings. Arch / Eng to review and approve the deviation prior to construction.
12. Multi ply beams with side loading to have all fasteners installed with the head on the side of the applied load
13. Confirmation of adequate support & anchorage of components is the responsibility of the building designer; suggested uplift connectors are as shown
14. Where beam hangs on side of 3-ply member, it is recommended that the equivalent quantity and size of nails required for the hanger attachment also be installed on opposite side of the 3-ply member

Legend

- PS Point Load Support
- Load from Above
- Wall
- Wall Opening
- Norbord Rimboard Plus 1.125 X 11.875
- AJS 140 11.875
- Versa-Lam LVL 2.1E 3100 SP 1.75 X 11.875
- 1.75 X 9.5 (Dropped)

CITY OF RICHMOND HILL
PLANNING DIVISION
10/24/2023
RECEIVED
Per: Joshua Nabua

Installation Guide



(Open your phone's camera and hover over this QR code to access it)






Client: GREENPARK
Project:
Address: PINETREE 11-2
RICHMOND HILL, ON

Date: 3/22/2023
Input by: W C
Job Name: PINETREE 11-2 STD
Project #: ROUNDEL HOMES INC

Page 1 of 23

F1-A AJ5 140 11.875" - PASSED

Level: Ground Floor



Member Information

Type:	Girder	Application:	Floor (Residential)
Plies:	1	Design Method:	LSD
Moisture Condition:	Dry	Building Code:	NBCC 2015 / OBC 2012
Deflection LL:	360	Load Sharing:	No
Deflection TL:	240	Deck:	Not Checked
Importance:	Normal - II	Vibration:	Not Checked
General Load			
Floor Live:	40 PSF		
Dead:	15 PSF		

Unfactored Reactions UNPATTERNED lb (Uplift)

Brg	Direction	Live	Dead	Snow	Wind
1	Vertical	70	26	0	0
2	Vertical	72	27	0	0

Bearings and Factored Reactions

Bearing	Length	Dir.	Cap.	React D/L lb	Total	Ld. Case	Ld. Comb.
1 - Hanger	2.000"	Vert	9%	33 / 105	138	L	1.25D+1.5L
2 - SPF	2.188"	Vert	9%	34 / 108	141	L	1.25D+1.5L

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	36 ft-lb	8 1/2"	5305 ft-lb	0.007 (1%)	1.25D+1.5L	L
Unbraced	36 ft-lb	8 1/2"	5305 ft-lb	0.007 (1%)	1.25D+1.5L	L
Shear	118 lb	1 1/4"	2350 lb	0.050 (5%)	1.25D+1.5L	L
Perm Defl in. (L/138899)	0.000	8 9/16"	0.040 (L/360)	0.003 (0%)	D	Uniform
LL Defl inch (L/52087)	0.000	8 9/16"	0.040 (L/360)	0.007 (1%)	L	L
TL Defl inch (L/37882)	0.000	8 9/16"	0.061 (L/240)	0.006 (1%)	D+L	L



APRIL 14, 2023

Design Notes

- Provide support to prevent lateral movement and rotation at the end bearings. Lateral support may also be required at the interior bearings by the building code.
- Fill all hanger nailing holes.
- Girders are designed to be supported on the bottom edge only.
- If sheathing is not attached to the top flange, top flange must be laterally braced at maximum 2' o.c.
- If sheathing is not attached to the bottom flange, bottom flange must be laterally braced at maximum 2' o.c.

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTES: EWP-FLOORS. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Tie-In	0-0-0 to 1-5-4	1-4-14	Top	15 PSF	40 PSF	0 PSF	0 PSF	
2	Tie-In	0-0-0 to 1-5-4	1-0-12	Top	15 PSF	40 PSF	0 PSF	0 PSF	

Notes

Calculated Structural Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

- Dry service conditions, unless noted otherwise
- Joist not to be treated with fire retardant or corrosive chemicals

chemicals

Handling & Installation

- Joist flanges must not be cut or drilled
- Refer to latest copy of the Joist product information details for framing details, stiffener tables, web chart, bridging details, multi-ply fastening details and handling/erection details
- Damaged Joists must not be used
- Design assumes top flange to be laterally restrained by attached sheathing or as specified in engineering notes.

- Provide lateral support at bearing points to avoid lateral displacement and rotation
- Web stiffeners for point load as shown Minimum point load bearing length >= 3.5 inches
- For flat roofs provide proper drainage to prevent ponding

This design is valid until 11/3/2024

Manufacturer Info

Boise Cascade Wood Products
1111 W. Jefferson St.
Boise, ID 83702
(800) 232-0788
www.bc.com
CCMC: 12787

Kott Inc.
3228 Moodie Dr, Ottawa, Ontario
613-838-2775 / 905-642-4400



Per: joshua.nabua




Client: GREENPARK
Project:
Address: PINETREE 11-2
RICHMOND HILL, ON

Date: 3/22/2023
Input by: W C
Job Name: PINETREE 11-2 STD
Project #: ROUNDEL HOMES INC


Page 2 of 23

F1-B AJS 140 11.875" - PASSED

Level: Ground Floor



1 Hanger (LF2511)
2 SPF
1'5 7/16"
1'5 7/16"


Member Information

Type:	Girder	Application:	Floor (Residential)
Plies:	1	Design Method:	LSD
Moisture Condition:	Dry	Building Code:	NBCC 2015 / OBC 2012
Deflection LL:	360	Load Sharing:	No
Deflection TL:	240	Deck:	Not Checked
Importance:	Normal - II	Vibration:	Not Checked
General Load			
Floor Live:	40 PSF		
Dead:	15 PSF		

Unfactored Reactions UNPATTERNED lb (Uplift)

Brg	Direction	Live	Dead	Snow	Wind
1	Vertical	61	23	0	0
2	Vertical	63	24	0	0

Bearings and Factored Reactions

Bearing	Length	Dir.	Cap.	React D/L lb	Total	Ld. Case	Ld. Comb.
1 - Hanger	2.000"	Vert	7%	29 / 92	120	L	1.25D+1.5L
2 - SPF	2.375"	Vert	7%	29 / 94	124	L	1.25D+1.5L

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	31 ft-lb	8 1/2"	5305 ft-lb	0.006 (1%)	1.25D+1.5L	L
Unbraced	31 ft-lb	8 1/2"	5305 ft-lb	0.006 (1%)	1.25D+1.5L	L
Shear	103 lb	1'3 13/16"	2350 lb	0.044 (4%)	1.25D+1.5L	L
Perm Defl in. (L/159417)	0.000	8 9/16"	0.040 (L/360)	0.002 (0%)	D	Uniform
LL Defl inch (L/59782)	0.000	8 9/16"	0.040 (L/360)	0.006 (1%)	L	L
TL Defl inch (L/43477)	0.000	8 9/16"	0.061 (L/240)	0.006 (1%)	D+L	L



APRIL 14, 2023

Design Notes

- Provide support to prevent lateral movement and rotation at the end bearings. Lateral support may also be required at the interior bearings by the building code.
- Fill all hanger nailing holes.
- Girders are designed to be supported on the bottom edge only.
- If sheathing is not attached to the top flange, top flange must be laterally braced at maximum 2' o.c.
- If sheathing is not attached to the bottom flange, bottom flange must be laterally braced at maximum 2' o.c.

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTES: EWP-FLOORS. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Tie-In	0-0-0 to 1-5-7	0-8-14	Top	15 PSF	40 PSF	0 PSF	0 PSF	
2	Tie-In	0-0-0 to 1-5-4	1-4-14	Top	15 PSF	40 PSF	0 PSF	0 PSF	

Notes

Calculated Structural Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

- Dry service conditions, unless noted otherwise
- Joist not to be treated with fire retardant or corrosive chemicals

chemicals

Handling & Installation

- Joist flanges must not be cut or drilled
- Refer to latest copy of the Joist product information details for framing details, stiffener tables, web chart, bridging details, multi-ply fastening details and handling/erection details
- Damaged Joists must not be used
- Design assumes top flange to be laterally restrained by attached sheathing or as specified in engineering notes.

- Provide lateral support at bearing points to avoid lateral displacement and rotation
- Web stiffeners for point load as shown Minimum point load bearing length >= 3.5 inches
- For flat roofs provide proper drainage to prevent ponding

This design is valid until 11/3/2024

Manufacturer Info

Boise Cascade Wood Products
1111 W. Jefferson St.
Boise, ID 83702
(800) 232-0788
www.bc.com
CCMC: 12787

Kott Inc.
3228 Moodie Dr, Ottawa, Ontario
613-838-2775 / 905-642-4400



Per: joshua.nabua




Client: GREENPARK
Project:
Address: PINETREE 11-2
RICHMOND HILL, ON

Date: 3/22/2023
Input by: W C
Job Name: PINETREE 11-2 STD
Project #: ROUNDEL HOMES INC


Page 3 of 23

F2-A AJ5 140 11.875" - PASSED

Level: Ground Floor

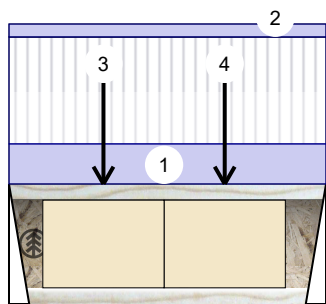

1 Hanger (LF2511)
2 Hanger (LF2511)
2'7 3/8"
2'7 3/8"


Member Information

Type:	Girder	Application:	Floor (Residential)
Plies:	1	Design Method:	LSD
Moisture Condition:	Dry	Building Code:	NBCC 2015 / OBC 2012
Deflection LL:	360	Load Sharing:	No
Deflection TL:	240	Deck:	Not Checked
Importance:	Normal - II	Vibration:	Not Checked
General Load			
Floor Live:	40 PSF		
Dead:	15 PSF		

Unfactored Reactions UNPATTERNED lb (Uplift)


Brg	Direction	Live	Dead	Snow	Wind
1	Vertical	335	236	0	0
2	Vertical	325	185	0	0

Bearings and Factored Reactions

Bearing	Length	Dir.	Cap.	React D/L lb	Total	Ld. Case	Ld. Comb.
1 - Hanger	2.000"	Vert	50%	295 / 502	796	L	1.25D+1.5L
2 - Hanger	2.000"	Vert	45%	232 / 487	719	L	1.25D+1.5L

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	519 ft-lb	1' 13/16"	5305 ft-lb	0.098 (10%)	1.25D+1.5L	L
Unbraced	519 ft-lb	1' 13/16"	5305 ft-lb	0.098 (10%)	1.25D+1.5L	L
Shear	789 lb	1 1/4"	2350 lb	0.336 (34%)	1.25D+1.5L	L
Perm Defl in. (L/10835)	0.003	11 5/16"	0.080 (L/360)	0.033 (3%)	D	Uniform
LL Defl inch	0.004 (L/7072)	1'4 5/8"	0.080 (L/360)	0.051 (5%)	L	L
TL Defl inch	0.007 (L/4321)	1'2 5/8"	0.120 (L/240)	0.056 (6%)	D+L	L



APRIL 14, 2023

Design Notes

- Provide support to prevent lateral movement and rotation at the end bearings. Lateral support may also be required at the interior bearings by the building code.
- Fill all hanger nailing holes.
- Girders are designed to be supported on the bottom edge only.
- If sheathing is not attached to the top flange, top flange must be laterally braced at maximum 2' o.c.
- If sheathing is not attached to the bottom flange, bottom flange must be laterally braced at maximum 2' o.c.

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTES: EWP-FLOORS. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Tie-In	0-0-0 to 2-7-6	0-9-15	Top	15 PSF	40 PSF	0 PSF	0 PSF	
2	Part. Uniform	0-0-0 to 2-7-6		Top	4 PLF	0 PLF	0 PLF	0 PLF	
3	Point	0-9-6		Near Face	239 lb	282 lb	0 lb	0 lb	J5
4	Point	1-9-6		Near Face	139 lb	291 lb	0 lb	0 lb	J5

Notes

Calculated Structural Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

- Dry service conditions, unless noted otherwise
- Joist not to be treated with fire retardant or corrosive chemicals

chemicals

Handling & Installation

- Joist flanges must not be cut or drilled
- Refer to latest copy of the Joist product information details for framing details, stiffener tables, web hole chart, bridging details, multi-ply fastening details and handling/erection details
- Damaged Joists must not be used
- Design assumes top flange to be laterally restrained by attached sheathing or as specified in engineering notes.

- Provide lateral support at bearing points to avoid lateral displacement and rotation
- Web stiffeners for point load as shown Minimum point load bearing length>= 3.5 inches
- For flat roofs provide proper drainage to prevent ponding

This design is valid until 11/3/2024

Manufacturer Info

Boise Cascade Wood Products
1111 W. Jefferson St.
Boise, ID 83702
(800) 232-0788
www.bc.com
CCMC: 12787

Kott Inc.
3228 Moodie Dr, Ottawa, Ontario
613-838-2775 / 905-642-4400



Per: joshua.nabua




Client: GREENPARK
Project:
Address: PINETREE 11- 2
RICHMOND HILL, ON

Date: 3/22/2023
Input by: W C
Job Name: PINETREE 11-2 STD
Project #: ROUNDEL HOMES INC

F3-A AJ5 140 11.875" - PASSED

Level: Ground Floor

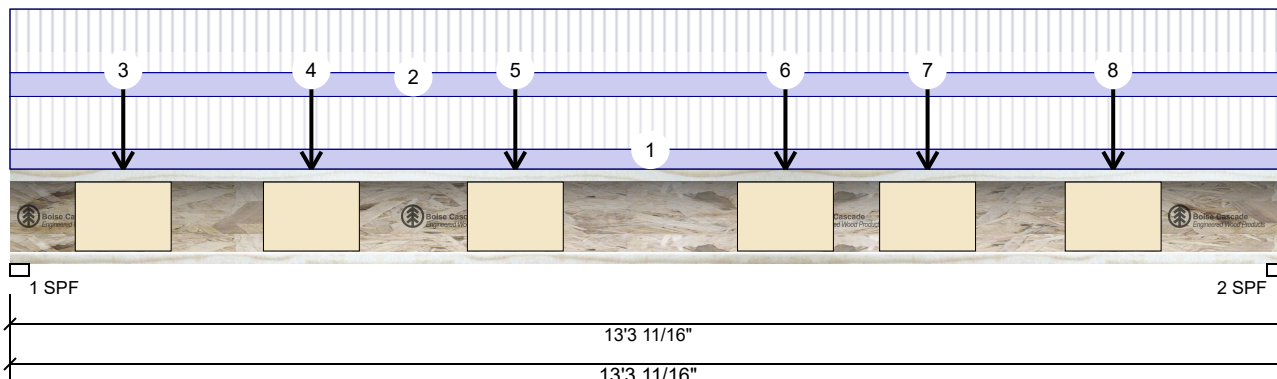

11 7/8"
2 1/2"

Member Information

Type:	Girder	Application:	Floor (Residential)
Plies:	1	Design Method:	LSD
Moisture Condition:	Dry	Building Code:	NBCC 2015 / OBC 2012
Deflection LL:	360	Load Sharing:	No
Deflection TL:	240	Deck:	Not Checked
Importance:	Normal - II	Vibration:	Not Checked
General Load			
Floor Live:	40 PSF		
Dead:	15 PSF		

Unfactored Reactions UNPATTERNED lb (Uplift)

Brg	Direction	Live	Dead	Snow	Wind
1	Vertical	563	211	0	0
2	Vertical	555	208	0	0

Bearings and Factored Reactions

Bearing	Length	Dir.	Cap.	React D/L lb	Total	Ld. Case	Ld. Comb.
1 - SPF	2.375"	Vert	66%	264 / 845	1109	L	1.25D+1.5L
2 - SPF	2.375"	Vert	65%	260 / 833	1092	L	1.25D+1.5L

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	3594 ft-lb	6'7 3/4"	5305 ft-lb	0.678 (68%)	1.25D+1.5L	L
Unbraced	3594 ft-lb	6'7 3/4"	5305 ft-lb	0.678 (68%)	1.25D+1.5L	L
Shear	1094 lb	1 5/8"	2350 lb	0.465 (47%)	1.25D+1.5L	L
Perm Defl in.	0.078 (L/2012)	6'7 7/8"	0.434 (L/360)	0.179 (18%)	D	Uniform
LL Defl inch	0.207 (L/754)	6'7 7/8"	0.434 (L/360)	0.478 (48%)	L	
TL Defl inch	0.285 (L/548)	6'7 7/8"	0.652 (L/240)	0.438 (44%)	D+L	L



APRIL 14, 2023

Design Notes

- 1 Provide support to prevent lateral movement and rotation at the end bearings. Lateral support may also be required at the interior bearings by the building code.
- 2 Girders are designed to be supported on the bottom edge only.
- 3 If sheathing is not attached to the top flange, top flange must be laterally braced at maximum 2' o.c.
- 4 Bottom flange must be laterally braced at a maximum of 2'9 13/16" o.c.

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTES: EWP-FLOORS. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Tie-In	0-0-0 to 13-3-11	0-8-0	Top	15 PSF	40 PSF	0 PSF	0 PSF	
2	Tie-In	0-0-0 to 13-3-11	0-9-10	Top	15 PSF	40 PSF	0 PSF	0 PSF	
3	Point	1-2-3		Near Face	17 lb	45 lb	0 lb	0 lb	J1
4	Point	3-1-11		Near Face	22 lb	58 lb	0 lb	0 lb	J1
5	Point	5-3-4		Near Face	26 lb	70 lb	0 lb	0 lb	F1
6	Point	8-1-0		Near Face	23 lb	61 lb	0 lb	0 lb	F1
7	Point	9-6-13		Near Face	18 lb	49 lb	0 lb	0 lb	J1
8	Point	11-6-1		Near Face	20 lb	54 lb	0 lb	0 lb	J1

Notes

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

1. Dry service conditions, unless noted otherwise
2. Joist not to be treated with fire retardant or corrosive chemicals

Handling & Installation

1. Joist flanges must not be cut or drilled
2. Refer to latest copy of the Joist product information details for framing details, stiffener tables, web hole chart, bridging details, multi-ply fastening details and handling/erection details
3. Damaged Joists must not be used
4. Design assumes top flange to be laterally restrained by attached sheathing or as specified in engineering notes.

5. Provide lateral support at bearing points to avoid lateral displacement and rotation
6. Web stiffeners for point load as shown Minimum point load bearing length>= 3.5 inches
7. For flat roofs provide proper drainage to prevent ponding

Manufacturer Info

Boise Cascade Wood Products
1111 W. Jefferson St.
Boise, ID 83702
(800) 232-0788
www.bc.com
CCMC: 12787

This design is valid until 11/3/2024

Kott Inc.
3228 Moodie Dr, Ottawa, Ontario
613-838-2775 / 905-642-4400



Per: joshua.nabua




Client: GREENPARK
Project:
Address: PINETREE 11-2
RICHMOND HILL, ON

Date: 3/22/2023
Input by: W C
Job Name: PINETREE 11-2 STD
Project #: ROUNDEL HOMES INC

Page 5 of 23

F4-A AJ5 140 11.875" - PASSED

Level: Ground Floor

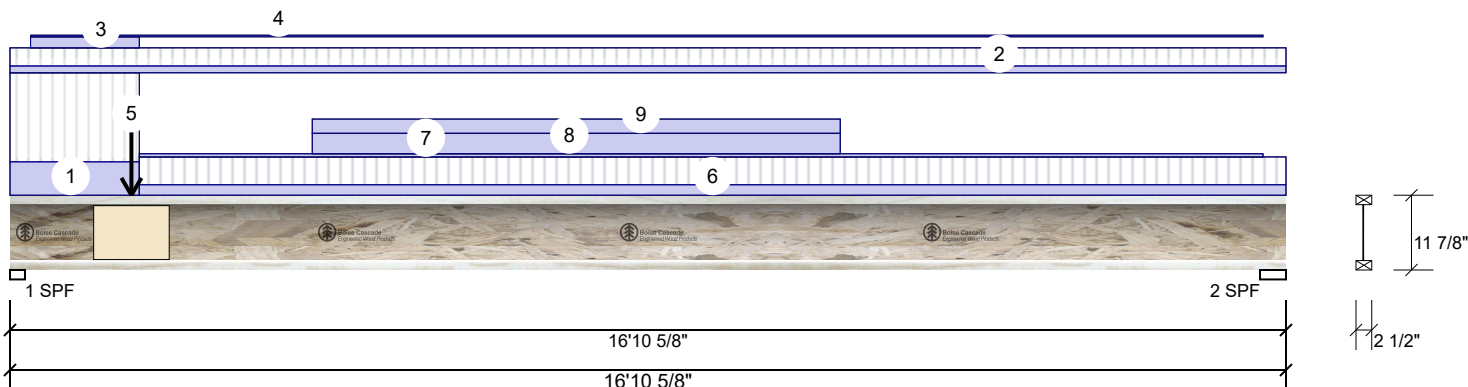

Member Information

Type:	Girder	Application:	Floor (Residential)
Plies:	1	Design Method:	LSD
Moisture Condition:	Dry	Building Code:	NBCC 2015 / OBC 2012
Deflection LL:	360	Load Sharing:	No
Deflection TL:	240	Deck:	Not Checked
Importance:	Normal - II	Vibration:	Not Checked
General Load			
Floor Live:	40 PSF		
Dead:	15 PSF		

Unfactored Reactions UNPATTERNED lb (Uplift)

Brg	Direction	Live	Dead	Snow	Wind
1	Vertical	613	446	0	0
2	Vertical	281	209	0	0

Bearings and Factored Reactions

Bearing	Length	Dir.	Cap.	React D/L lb	Total	Ld. Case	Ld. Comb.
1 - SPF	2.375"	Vert	88%	558 / 919	1477	L	1.25D+1.5L
2 - SPF	4.125"	Vert	36%	261 / 422	683	L	1.25D+1.5L

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	3371 ft-lb	7'4 1/16"	5305 ft-lb	0.636 (64%)	1.25D+1.5L	L
Unbraced	3371 ft-lb	7'4 1/16"	5305 ft-lb	0.636 (64%)	1.25D+1.5L	L
Shear	1459 lb	1 5/8"	2350 lb	0.621 (62%)	1.25D+1.5L	L
Perm Defl in.	0.198 (L/999)	8' 7/16"	0.549 (L/360)	0.360 (36%)	D	Uniform
LL Defl inch	0.224 (L/881)	8' 7/16"	0.549 (L/360)	0.409 (41%)	L	
TL Defl inch	0.422 (L/468)	8' 7/16"	0.823 (L/240)	0.513 (51%)	D+L	L

Design Notes

- 1 Provide support to prevent lateral movement and rotation at the end bearings. Lateral support may also be required at the interior bearings by the building code.
- 2 Girders are designed to be supported on the bottom edge only.
- 3 If sheathing is not attached to the top flange, top flange must be laterally braced at maximum 2' o.c.
- 4 Bottom flange must be laterally braced at a maximum of 15'3 5/16" o.c.



APRIL 14, 2023

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTES: EWP-FLOORS. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Tie-In	0-0-0 to 1-8-9	1-4-15	Top	15 PSF	40 PSF	0 PSF	0 PSF	
2	Tie-In	0-0-0 to 16-10-10	0-3-7	Top	15 PSF	40 PSF	0 PSF	0 PSF	
3	Part. Uniform	0-3-4 to 1-8-9		Top	7 PLF	0 PLF	0 PLF	0 PLF	
4	Part. Uniform	0-3-5 to 16-6-15		Top	1 PLF	0 PLF	0 PLF	0 PLF	
5	Point	1-7-5		Far Face	236 lb	335 lb	0 lb	0 lb	F2
6	Tie-In	1-8-9 to 16-10-10	0-5-5	Top	15 PSF	40 PSF	0 PSF	0 PSF	
7	Part. Uniform	1-8-9 to 16-6-15		Top	2 PLF	0 PLF	0 PLF	0 PLF	

Continued on page 2...

Notes

Calculated Structural Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

1. Dry service conditions, unless noted otherwise
2. Joist not to be treated with fire retardant or corrosive chemicals

chemicals

Handling & Installation

1. Joist flanges must not be cut or drilled
2. Refer to latest copy of the Joist product information details for framing details, stiffener tables, web hole chart, bridging details, multi-ply fastening details and handling/erection details
3. Damaged Joists must not be used
4. Design assumes top flange to be laterally restrained by attached sheathing or as specified in engineering notes.

5. Provide lateral support at bearing points to avoid lateral displacement and rotation
6. Web stiffeners for point load as shown Minimum point load bearing length >= 3.5 inches
7. For flat roofs provide proper drainage to prevent ponding

This design is valid until 11/3/2024

Manufacturer Info

Boise Cascade Wood Products
1111 W. Jefferson St.
Boise, ID 83702
(800) 232-0788
www.bc.com
CCMC: 12787

Kott Inc.
3228 Moodie Dr, Ottawa, Ontario
613-838-2775 / 905-642-4400



Per: joshua.nabua




Client: GREENPARK
 Project:
 Address: PINETREE 11- 2
 RICHMOND HILL, ON

Date: 3/22/2023
 Input by: W C
 Job Name: PINETREE 11-2 STD
 Project #: ROUNDEL HOMES INC

Page 6 of 23

F4-A AJ5 140 11.875" - PASSED

Level: Ground Floor

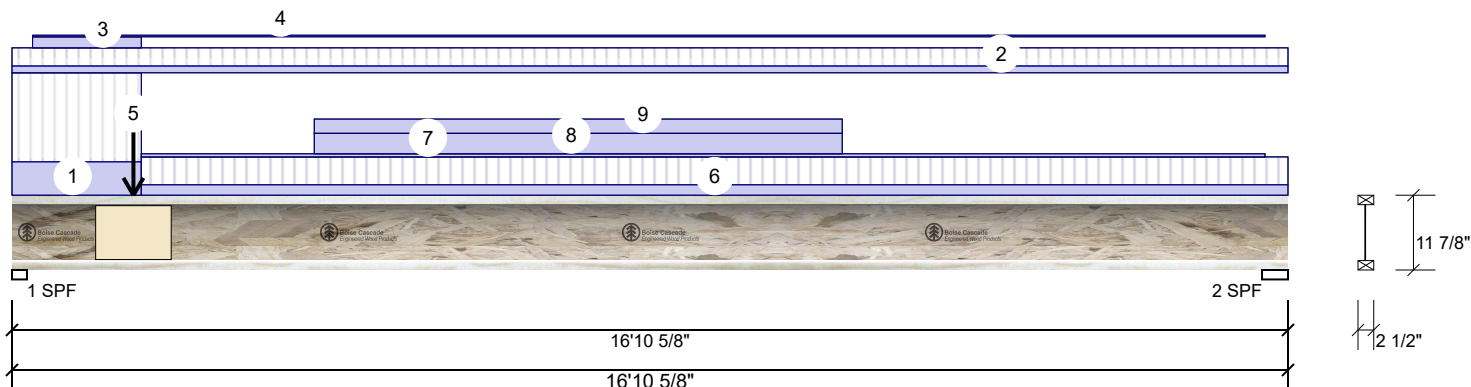

...Continued from page 1

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
8	Part. Uniform	4-0-0 to 10-11-13		Top	13 PLF	0 PLF	0 PLF	0 PLF	
9	Part. Uniform	4-0-0 to 10-11-13		Top	9 PLF	0 PLF	0 PLF	0 PLF	



APRIL 14, 2023

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTES: EWP-FLOORS. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

Notes

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

1. Dry service conditions, unless noted otherwise
2. Ljoist not to be treated with fire retardant or corrosive

chemicals

Handling & Installation

1. Ljoist flanges must not be cut or drilled
2. Refer to latest copy of the Ljoist product information details for framing details, stiffener tables, web hole chart, bridging details, multi-ply fastening details and handling/erection details
3. Damaged Ljoists must not be used
4. Design assumes top flange to be laterally restrained by attached sheathing or as specified in engineering notes.

5. Provide lateral support at bearing points to avoid lateral displacement and rotation
6. Web stiffeners for point load as shown Minimum point load bearing length >= 3.5 inches
7. For flat roofs provide proper drainage to prevent ponding

This design is valid until 11/3/2024

Manufacturer Info

Boise Cascade Wood Products
 1111 W. Jefferson St.
 Boise, ID 83702
 (800) 232-0788
 www.bc.com
 CCMC: 12787

Kott Inc.
 3228 Moodie Dr, Ottawa, Ontario
 613-838-2775 / 905-642-4400



Per: joshua.nabua




Client: GREENPARK
Project:
Address: PINETREE 11- 2
RICHMOND HILL, ON

Date: 3/22/2023
Input by: W C
Job Name: PINETREE 11-2 STD
Project #: ROUNDEL HOMES INC

Page 7 of 23

F4-B AJS 140 11.875" - PASSED

Level: Ground Floor

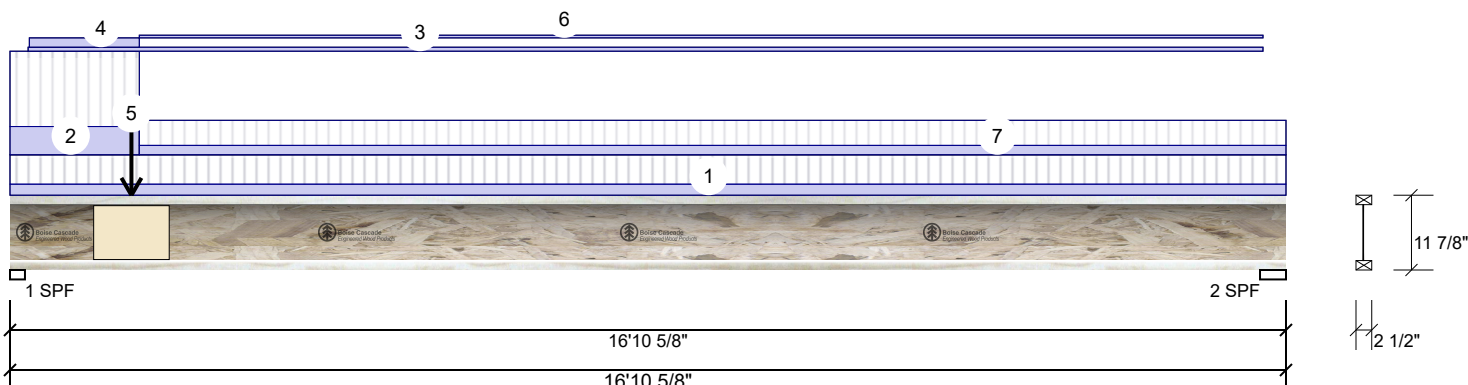

Member Information

Type:	Girder	Application:	Floor (Residential)
Plies:	1	Design Method:	LSD
Moisture Condition:	Dry	Building Code:	NBCC 2015 / OBC 2012
Deflection LL:	360	Load Sharing:	No
Deflection TL:	240	Deck:	Not Checked
Importance:	Normal - II	Vibration:	Not Checked
General Load			
Floor Live:	40 PSF		
Dead:	15 PSF		

Unfactored Reactions UNPATTERNED lb (Uplift)

Brg	Direction	Live	Dead	Snow	Wind
1	Vertical	699	367	0	0
2	Vertical	380	189	0	0

Bearings and Factored Reactions

Bearing	Length	Dir.	Cap. React	D/L lb	Total	Ld. Case	Ld. Comb.
1 - SPF	2.375"	Vert	90%	459 / 1049	1508	L	1.25D+1.5L
2 - SPF	4.125"	Vert	42%	237 / 569	806	L	1.25D+1.5L

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	3544 ft-lb	7'6 11/16"	5305 ft-lb	0.668 (67%)	1.25D+1.5L	L
Unbraced	3544 ft-lb	7'6 11/16"	5305 ft-lb	0.668 (67%)	1.25D+1.5L	L
Shear	1487 lb	1 5/8"	2350 lb	0.633 (63%)	1.25D+1.5L	L
Perm Defl in.	0.148 (L/1335)	8'1 1/8"	0.549 (L/360)	0.270 (27%)	D	Uniform
LL Defl inch	0.290 (L/680)	8'1 7/16"	0.549 (L/360)	0.529 (53%)	L	L
TL Defl inch	0.438 (L/451)	8'1 3/8"	0.823 (L/240)	0.533 (53%)	D+L	L

Design Notes

- Provide support to prevent lateral movement and rotation at the end bearings. Lateral support may also be required at the interior bearings by the building code.
- Girders are designed to be supported on the bottom edge only.
- If sheathing is not attached to the top flange, top flange must be laterally braced at maximum 2' o.c.
- Bottom flange must be laterally braced at a maximum of 15'3 5/16" o.c.



APRIL 14, 2023

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTES: EWP-FLOORS. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Tie-In	0-0-0 to 16-10-10	0-6-10	Top	15 PSF	40 PSF	0 PSF	0 PSF	
2	Tie-In	0-0-0 to 1-8-9	1-4-15	Top	15 PSF	40 PSF	0 PSF	0 PSF	
3	Part. Uniform	0-2-14 to 16-6-15		Top	3 PLF	0 PLF	0 PLF	0 PLF	
4	Part. Uniform	0-3-1 to 1-8-9		Top	7 PLF	0 PLF	0 PLF	0 PLF	
5	Point	1-7-5		Near Face	185 lb	325 lb	0 lb	0 lb	F2
6	Part. Uniform	1-8-9 to 16-6-15		Top	2 PLF	0 PLF	0 PLF	0 PLF	
7	Tie-In	1-8-9 to 16-10-10	0-5-10	Top	15 PSF	40 PSF	0 PSF	0 PSF	

Notes

Calculated Structural Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

- Dry service conditions, unless noted otherwise
- Joist not to be treated with fire retardant or corrosive chemicals

Handling & Installation

- Joist flanges must not be cut or drilled
- Refer to latest copy of the Joist product information details for framing details, stiffener tables, web hole chart, bridging details, multi-ply fastening details and handling/erection details
- Damaged Joists must not be used
- Design assumes top flange to be laterally restrained by attached sheathing or as specified in engineering notes.

- Provide lateral support at bearing points to avoid lateral displacement and rotation
- Web stiffeners for point load as shown Minimum point load bearing length >= 3.5 inches
- For flat roofs provide proper drainage to prevent ponding

This design is valid until 11/3/2024

Manufacturer Info

Boise Cascade Wood Products
1111 W. Jefferson St.
Boise, ID 83702
(800) 232-0788
www.bc.com
CCMC: 12787

Kott Inc.
3228 Moodie Dr, Ottawa, Ontario
613-838-2775 / 905-642-4400



Per: joshua.nabua





Client: GREENPARK
Project:
Address: PINETREE 11-2
RICHMOND HILL, ON

Date: 3/22/2023
Input by: W C
Job Name: PINETREE 11-2 STD
Project #: ROUNDEL HOMES INC

Page 8 of 23

F5-B Versa-Lam LVL 2.1E 3100 SP 1.750" X 11.875" - PASSED

Level: Ground Floor

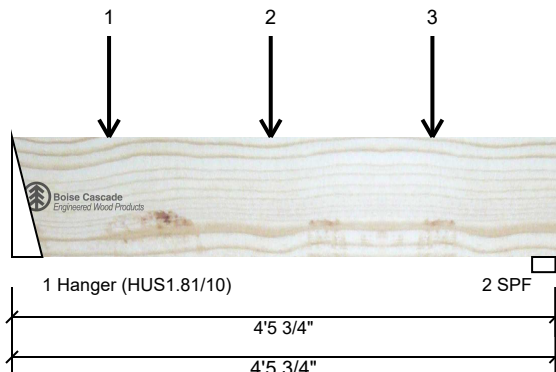**Member Information**

Type:	Girder	Application:	Floor (Residential)
Plies:	1	Design Method:	LSD
Moisture Condition:	Dry	Building Code:	NBCC 2015 / OBC 2012
Deflection LL:	360	Load Sharing:	No
Deflection TL:	240	Deck:	Not Checked
Importance:	Normal - II	Vibration:	Not Checked
General Load			
Floor Live:	40 PSF		
Dead:	15 PSF		

Unfactored Reactions UNPATTERNED lb (Uplift)

Brg	Direction	Live	Dead	Snow	Wind
1	Vertical	161	74	0	0
2	Vertical	141	66	0	0

Bearings and Factored Reactions

Bearing	Length	Dir.	Cap.	React D/L lb	Total	Ld. Case	Ld. Comb.
1 - Hanger	3.000"	Vert	6%	92 / 242	335	L	1.25D+1.5L
2 - SPF	2.313"	Vert	12%	82 / 211	293	L	1.25D+1.5L

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	383 ft-lb	2'1 5/8"	17696 ft-lb	0.022 (2%)	1.25D+1.5L	L
Unbraced	383 ft-lb	2'1 5/8"	17696 ft-lb	0.022 (2%)	1.25D+1.5L	L
Shear	333 lb	1'2 7/8"	6608 lb	0.050 (5%)	1.25D+1.5L	L
Perm Defl in. (L/96713)	0.001	2'2 3/4"	0.139 (L/360)	0.004 (0%)	D	Uniform
LL Defl inch (L/43304)	0.001	2'2 5/8"	0.139 (L/360)	0.008 (1%)	L	L
TL Defl inch (L/29911)	0.002	2'2 5/8"	0.208 (L/240)	0.008 (1%)	D+L	L



APRIL 14, 2023

Design Notes

- 1 Provide support to prevent lateral movement and rotation at the end bearings. Lateral support may also be required at the interior bearings by the building code.
- 2 Fill all hanger nailing holes.
- 3 Girders are designed to be supported on the bottom edge only.
- 4 Top must be continuously laterally braced.
- 5 Bottom must have sheathing attached or be continuously braced.

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTES: EWP-FLOORS. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Point	0-9-10		Far Face	36 lb	96 lb	0 lb	0 lb	J2
2	Point	2-1-10		Far Face	42 lb	112 lb	0 lb	0 lb	J2
3	Point	3-5-10		Far Face	35 lb	94 lb	0 lb	0 lb	J2
	Self Weight				6 PLF				

Notes

Calculated Structural Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive chemicals

chemicals

Handling & Installation

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding

This design is valid until 11/3/2024

Manufacturer Info

Boise Cascade Wood Products
1111 W. Jefferson St.
Boise, ID 83702
(800) 232-0788
www.bc.com
CCMC: 12472

Kott Inc.
3228 Moodie Dr, Ottawa, Ontario
613-838-2775 / 905-642-4400



Per: CS DESIGN BUILD
Per: joshua.nabua





Client: GREENPARK
Project:
Address: PINETREE 11- 2
RICHMOND HILL, ON

Date: 3/22/2023
Input by: W C
Job Name: PINETREE 11-2 STD
Project #: ROUNDEL HOMES INC

Page 9 of 23

F5-C Versa-Lam LVL 2.1E 3100 SP 1.750" X 11.875" - PASSED

Level: Ground Floor

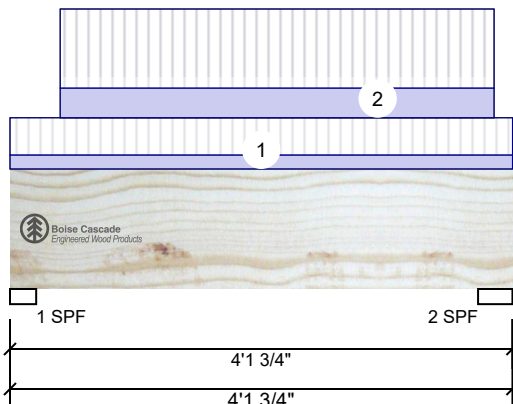

Member Information

Type:	Girder	Application:	Floor (Residential)
Plies:	1	Design Method:	LSD
Moisture Condition:	Dry	Building Code:	NBCC 2015 / OBC 2012
Deflection LL:	360	Load Sharing:	No
Deflection TL:	240	Deck:	Not Checked
Importance:	Normal - II	Vibration:	Not Checked
General Load			
Floor Live:	40 PSF		
Dead:	15 PSF		

Unfactored Reactions UNPATTERNED lb (Uplift)

Brg	Direction	Live	Dead	Snow	Wind
1	Vertical	104	51	0	0
2	Vertical	117	57	0	0

Bearings and Factored Reactions

Bearing	Length	Dir.	Cap.	React D/L lb	Total	Ld. Case	Ld. Comb.
1 - SPF	2.590"	Vert	8%	64 / 156	219	L	1.25D+1.5L
2 - SPF	3.403"	Vert	7%	71 / 176	247	L	1.25D+1.5L

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	217 ft-lb	2' 1/2"	17696 ft-lb	0.012 (1%)	1.25D+1.5L	L
Unbraced	217 ft-lb	2' 1/2"	17696 ft-lb	0.012 (1%)	1.25D+1.5L	L
Shear	111 lb	1'2 7/16"	6608 lb	0.017 (2%)	1.25D+1.5L	L
Perm Defl in. (L/166078)	0.000	2' 1/2"	0.126 (L/360)	0.002 (0%)	D	Uniform
LL Defl inch (L/79110)	0.001	2' 1/2"	0.126 (L/360)	0.005 (0%)	L	L
TL Defl inch (L/53585)	0.001	2' 1/2"	0.188 (L/240)	0.004 (0%)	D+L	L



APRIL 14, 2023

Design Notes

- Provide support to prevent lateral movement and rotation at the end bearings. Lateral support may also be required at the interior bearings by the building code.
- Girders are designed to be supported on the bottom edge only.
- Top must be continuously laterally braced.
- Bottom must be laterally braced at bearings.

READ ALL NOTES ON THIS PAGE AND ON THE
ENGINEERING NOTES: EWP-FLOORS. THE NOTE
PAGE IS AN INTEGRAL PART OF THIS DRAWING
AS IT CONTAINS SPECIFICATIONS AND CRITERIA
USED IN THE DESIGN OF THIS COMPONENT.

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Tie-In	0-0-0 to 4-1-12	0-5-10	Top	15 PSF	40 PSF	0 PSF	0 PSF	
2	Part. Uniform	0-4-15 to 3-11-14		Top	15 PLF	40 PLF	0 PLF	0 PLF	
	Self Weight				6 PLF				

Notes

Calculated Structural Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

- Dry service conditions, unless noted otherwise
- LVL not to be treated with fire retardant or corrosive

chemicals

Handling & Installation

- LVL beams must not be cut or drilled
- Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
- Damaged Beams must not be used
- Design assumes top edge is laterally restrained
- Provide lateral support at bearing points to avoid lateral displacement and rotation

- For flat roofs provide proper drainage to prevent ponding

Manufacturer Info

Boise Cascade Wood Products
1111 W. Jefferson St.
Boise, ID 83702
(800) 232-0788
www.bc.com
CCMC: 12472

This design is valid until 11/3/2024

Kott Inc.
3228 Moodie Dr, Ottawa, Ontario
613-838-2775 / 905-642-4400



Per: joshua.nabua





Client: GREENPARK
Project:
Address: PINETREE 11- 2
RICHMOND HILL, ON

Date: 3/22/2023
Input by: W C
Job Name: PINETREE 11-2 STD
Project #: ROUNDEL HOMES INC

F6-C Versa-Lam LVL 2.1E 3100 SP 1.750" X 11.875" 2-Ply - PASSED

Level: Ground Floor

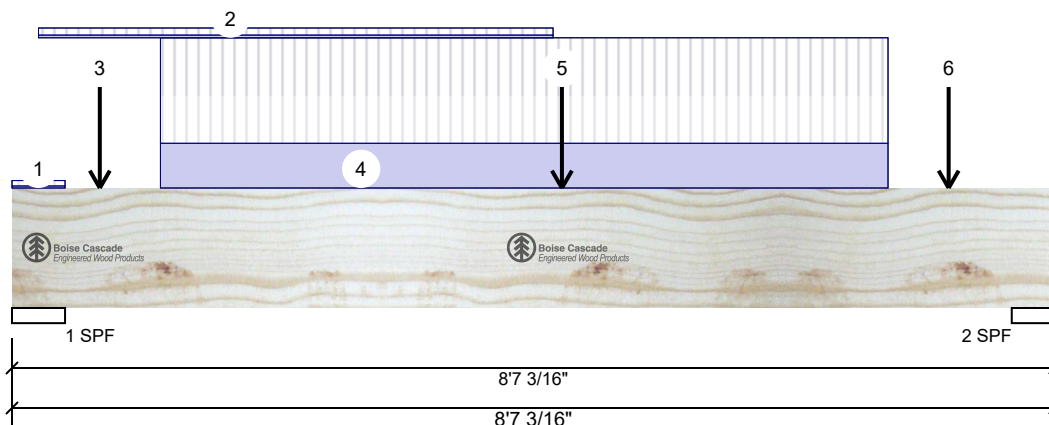
Member Information

Type:	Girder	Application:	Floor (Residential)
Plies:	2	Design Method:	LSD
Moisture Condition:	Dry	Building Code:	NBCC 2015 / OBC 2012
Deflection LL:	360	Load Sharing:	No
Deflection TL:	240	Deck:	Not Checked
Importance:	Normal - II	Vibration:	Not Checked
General Load			
Floor Live:	40 PSF		
Dead:	15 PSF		

Unfactored Reactions UNPATTERNED lb (Uplift)

Brg	Direction	Live	Dead	Snow	Wind
1	Vertical	1204	562	0	0
2	Vertical	1184	558	0	0

Bearings and Factored Reactions

Bearing	Length	Dir.	Cap.	React D/L lb	Total	Ld. Case	Ld. Comb.
1 - SPF	5.250"	Vert	22%	702 / 1806	2508	L	1.25D+1.5L
2 - SPF	4.268"	Vert	27%	697 / 1777	2474	L	1.25D+1.5L

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	5358 ft-lb	4'6 7/16"	35392 ft-lb	0.151 (15%)	1.25D+1.5L	L
Unbraced	5358 ft-lb	4'6 7/16"	35392 ft-lb	0.151 (15%)	1.25D+1.5L	L
Shear	2549 lb	7'3 1/16"	13217 lb	0.193 (19%)	1.25D+1.5L	L
Perm Defl in.	0.013 (L/7217)	4'4 3/16"	0.264 (L/360)	0.050 (5%)	D	Uniform
LL Defl inch	0.028 (L/3343)	4'4 3/16"	0.264 (L/360)	0.108 (11%)	L	L
TL Defl inch	0.042 (L/2284)	4'4 3/16"	0.397 (L/240)	0.105 (11%)	D+L	L

Design Notes

- 1 Provide support to prevent lateral movement and rotation at the end bearings. Lateral support may also be required at the interior bearings by the building code.
- 2 Girders are designed to be supported on the bottom edge only.
- 3 Multiple plies must be fastened together as per manufacturer's details.
- 4 Top loads must be supported equally by all plies.
- 5 Top must be continuously laterally braced.
- 6 Bottom must have sheathing attached or be continuously braced.
- 7 Lateral slenderness ratio based on full section width.



APRIL 14, 2023

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTES: EWP-FLOORS. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Tie-In	0-0-0 to 0-5-4	0-4-5	Top	15 PSF	40 PSF	0 PSF	0 PSF	
2	Tie-In	0-2-10 to 4-5-9	0-5-11	Top	15 PSF	40 PSF	0 PSF	0 PSF	
3	Point	0-8-11		Near Face	77 lb	181 lb	0 lb	0 lb	J5
4	Part. Uniform	1-2-11 to 7-2-11		Near Face	119 PLF	281 PLF	0 PLF	0 PLF	
5	Point	4-6-7		Far Face	74 lb	161 lb	0 lb	0 lb	F5

Continued on page 2...

Notes

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive chemicals

chemicals

Handling & Installation

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding

This design is valid until 11/3/2024

Manufacturer Info

Boise Cascade Wood Products
1111 W. Jefferson St.
Boise, ID 83702
(800) 232-0788
www.bc.com
CCMC: 12472

Kott Inc.
3228 Moodie Dr, Ottawa, Ontario
613-838-2775 / 905-642-4400



Per: joshua.nabua





Client: GREENPARK
 Project:
 Address: PINETREE 11- 2
 RICHMOND HILL, ON

Date: 3/22/2023
 Input by: W C
 Job Name: PINETREE 11-2 STD
 Project #: ROUNDEL HOMES INC

Page 11 of 23

F6-C Versa-Lam LVL 2.1E 3100 SP 1.750" X 11.875" 2-Ply - PASSED

Level: Ground Floor

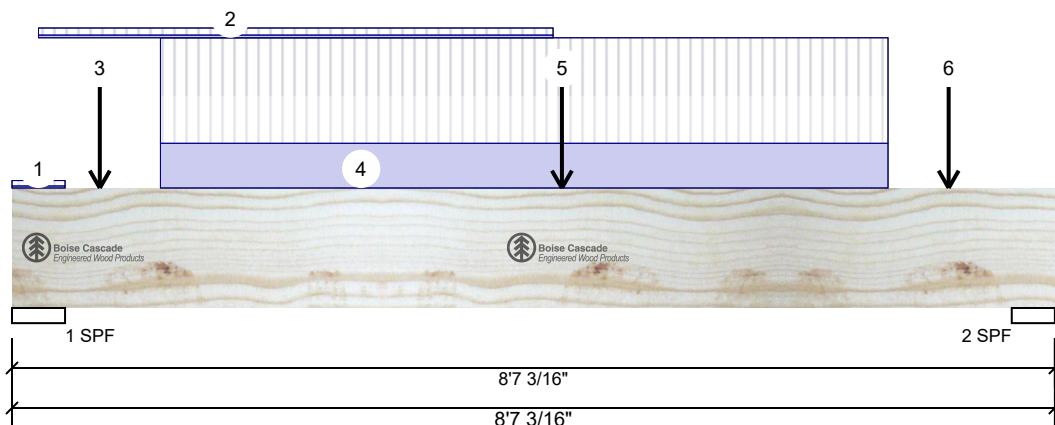

...Continued from page 1

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
6	Point	7-8-11		Near Face	120 lb	274 lb	0 lb	0 lb	J5
	Self Weight				12 PLF				



APRIL 14, 2023

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTES: EWP-FLOORS. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

Notes

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive

chemicals

Handling & Installation

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding

This design is valid until 11/3/2024

Manufacturer Info


Boise Cascade Wood Products
 1111 W. Jefferson St.
 Boise, ID 83702
 (800) 232-0788
 www.bc.com
 CCMC: 12472

Kott Inc.
 3228 Moodie Dr, Ottawa, Ontario
 613-838-2775 / 905-642-4400



Per: joshua.nabua

Second Floor

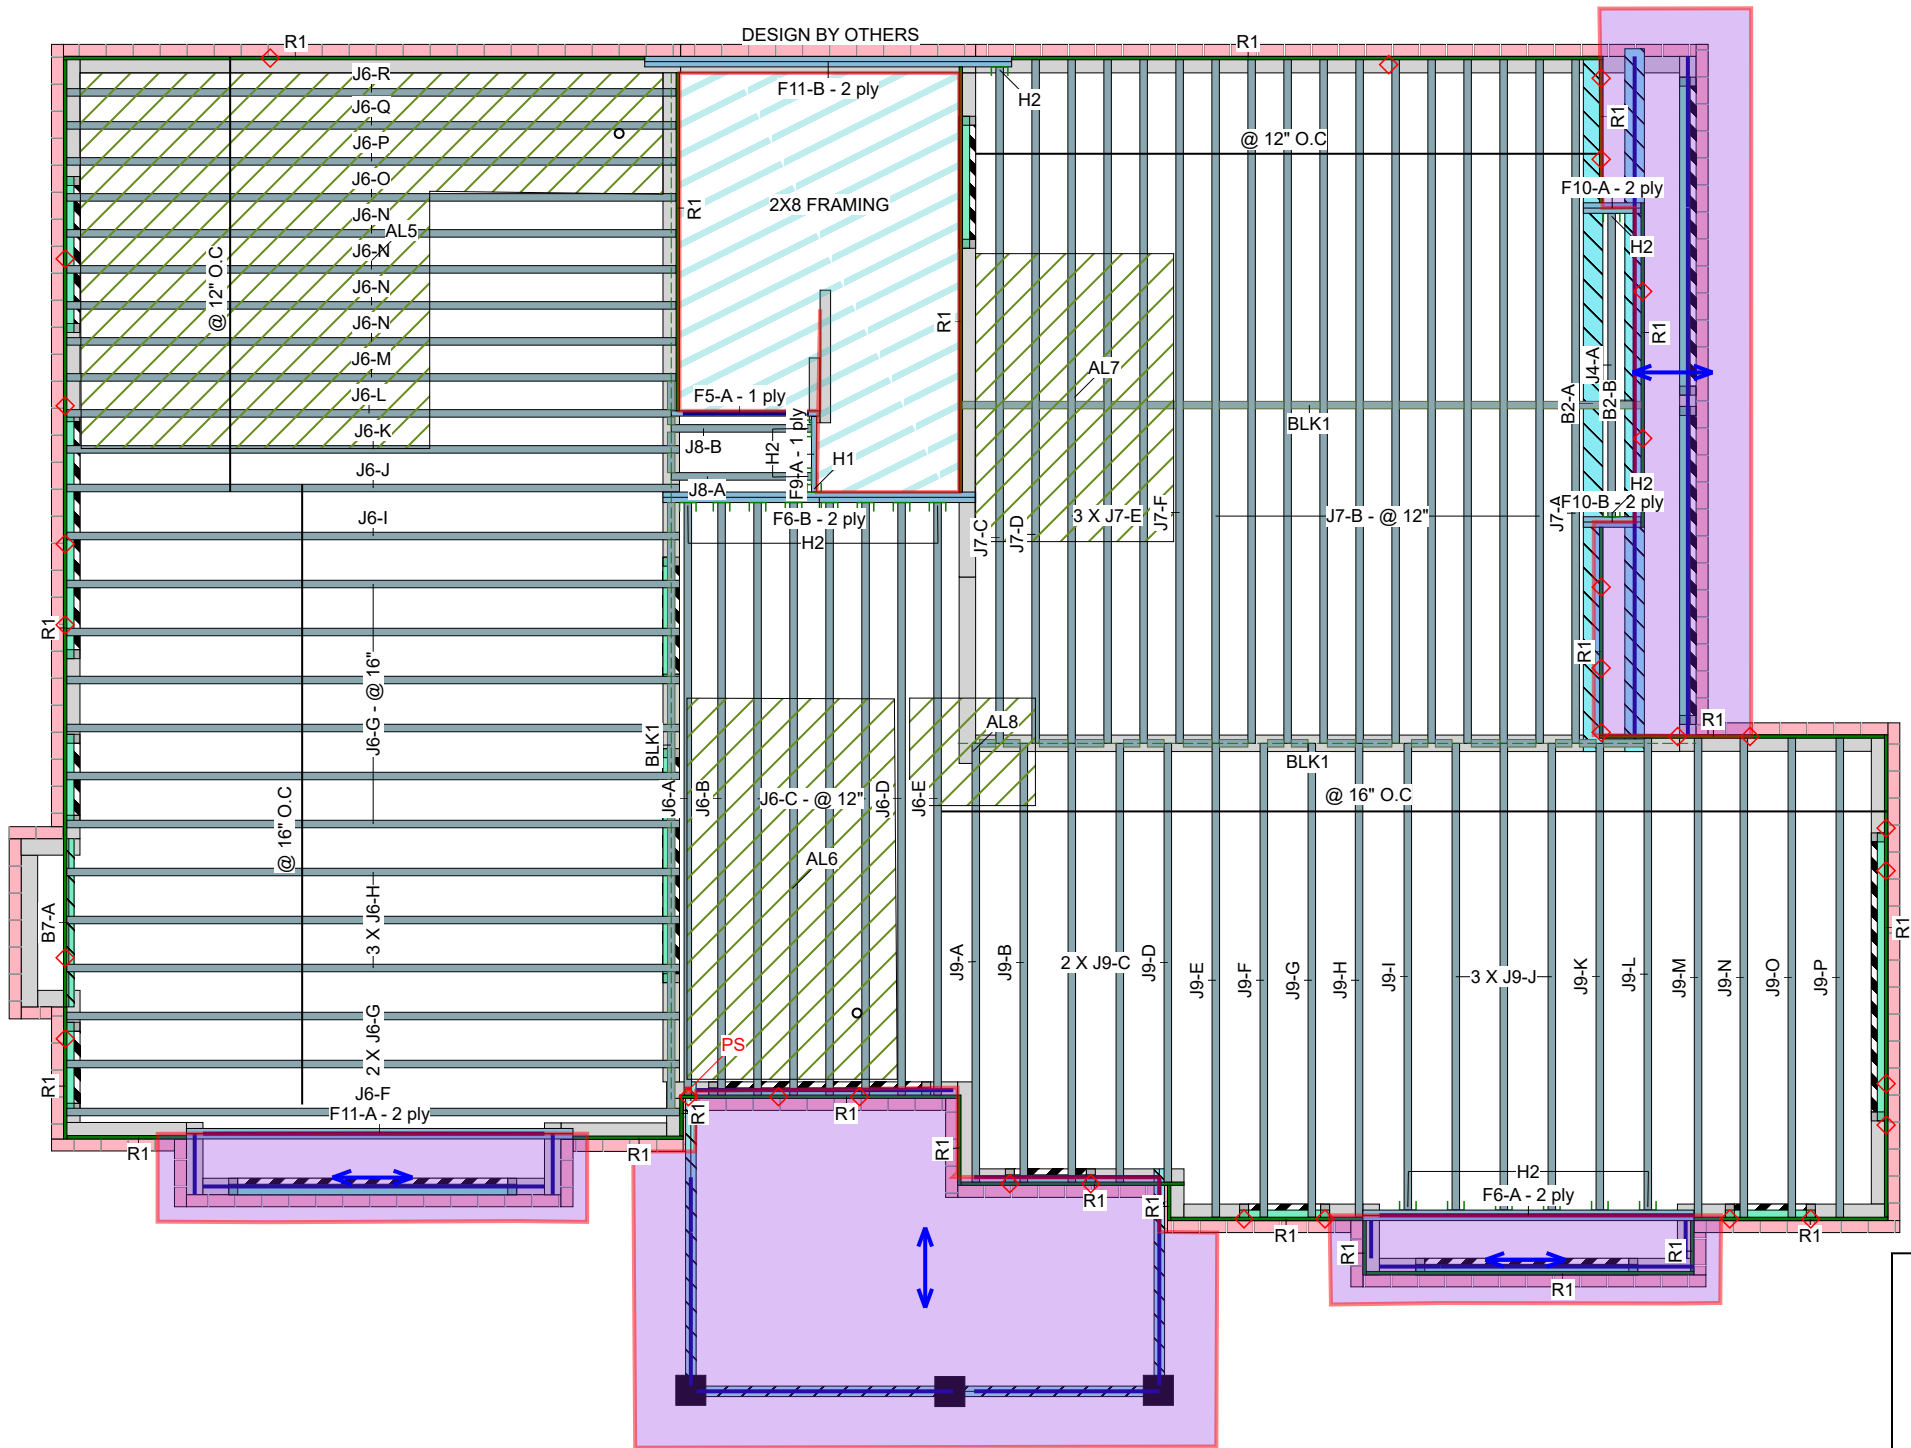

Installation Guide



(Open your phone's camera and hover over this QR code to access it)

Hatch Area represents where additional load has been applied. (e.g. 5 psf for ceramic tile)

1. All blocking to be cut from 12' joists
2. 2' & 4' Lengths to be cut from 8' Length, 6' lengths to be cut from 12' Length
3. Ends of joists to be laterally supported
4. Packing of Steel beams and attachment by others
5. Shower and water closet flange locations are approximate only, consult architectural drawing for exact locations
6. Beams identified as "B" are dropped and supplied by others
7. Install 2x4 blocking @ 24" o/c under parallel non-loadbearing walls
8. Load transfer blocks to be installed under all point loads
9. Refer to Multiple Member Connection Detail for ply to ply nailing or bolting requirements
10. Hangers and Fasteners to be installed as per manufacturer
11. Framing shown on this layout may deviate from architectural drawings. Arch / Eng to review and approve the deviation prior to construction.
12. Multi ply beams with side loading to have all fasteners installed with the head on the side of the applied load
13. Confirmation of adequate support & anchorage of components is the responsibility of the building designer; suggested uplift connectors are as shown
14. Where beam hangs on side of 3-ply member, it is recommended that the equivalent quantity and size of nails required for the hanger attachment also be installed on opposite side of the 3-ply member

Second Floor LVL/LSL (Flush)							
Label	Description	Width	Depth	Qty	Plies	Pcs	Length
F11	Versa-Lam LVL 2.1E 3100 SP	1.75	11.875	2	2	4	12-0-0
F6	Versa-Lam LVL 2.1E 3100 SP	1.75	11.875	2	2	4	10-0-0
F5	Versa-Lam LVL 2.1E 3100 SP	1.75	11.875			1	6-0-0
F9	Versa-Lam LVL 2.1E 3100 SP	1.75	11.875			1	4-0-0
F10	Versa-Lam LVL 2.1E 3100 SP	1.75	11.875	2	2	4	2-0-0

I Joist (Flush)							
Label	Description	Width	Depth	Qty	Plies	Pcs	Length
J7	AJS 140	2.5	11.875			17	20-0-0
J6	AJS 140	2.5	11.875			33	18-0-0
J9	AJS 140	2.5	11.875			19	14-0-0
J4	AJS 140	2.5	11.875			1	10-0-0
J8	AJS 140	2.5	11.875			2	4-0-0

Rim Board							
Label	Description	Width	Depth	Qty	Plies	Pcs	Length
R1	Norbord Rimboard Plus 1.125 X 11.875	1.125	11.875			15	12-0-0

Blocking							
Label	Description	Width	Depth	Qty	Plies	Pcs	Length
BLK1	AJS 140	2.5	11.875	LinFt		Varies	44-0-0

Hanger							
				Beam/Girder		Supported Member	
Label	Pcs	Description	Skew	Slope	fasteners	fasteners	
H1	1	HUS1.81/10			30 16d	10 16d	
H2	19	LF2511			12 10d	1 #8x1 1/4WS	

JOB INFORMATION	
Builder	GREENPARK
Project	ROUNDEL HOMES INC
Shipping	PINETREE 11- 2 RICHMOND HILL, ON
Sales Rep	RALPH MIRIGELLO
Designer	W C
Plotted	April 10, 2023
Layout Name	PINETREE 11-2 STD & DC
Job Path	S:\CUSTOMERS\GREENPARK\ROUNDEL HOMES INC\MODELS\PINETREE 11\PINETREE 11-ELEV 2\F-PT11-2\PINETREE 11-2 STD & DC.isl

DESIGN CRITERIA	
Second Floor	
Design Method	LSD (Canada)
Building Code	NBCC 2015 / OBC 2012

Floor Loads	
Live	40
Dead	15
Deflection Joist	
LL Span L/	360
TL Span L/	240
Deflection Flush Girder	
LL Span L/	360
TL Span L/	240
Deflection Dropped Girder	
LL Span L/	360
TL Span L/	240
Deflection Header	
LL Span L/	360
TL Span L/	240
Decking	OSB
Thickness	5/8"
Fastener	Nailed & Glued

CCMC References	
Boise - 12472-R , 12787-R	
LP - 12412-R, Roseburg - 13310-R	
Forex - 14056-R	

Kott Inc.	
3228 Moodie Dr, Ottawa	
14 Anderson Blvd, Uxbridge	
Ontario	
613-838-2775 / 905-642-4400	



Legend

- PS Point Load Support
- Load from Above
- Wall
- Wall Opening
- Norbord Rimboard Plus 1.125 X 11.875
- AJS 140 11.875
- Versa-Lam LVL 2.1E 3100 SP 1.75 X 11.875
- 1.75 X 9.5 (Dropped)

CITY OF RICHMOND HILL

RECEIVED

Per: joshua nabua

5/24/2023





Client: GREENPARK
 Project:
 Address: PINETREE 11- 2
 RICHMOND HILL, ON

Date: 3/22/2023
 Input by: W C
 Job Name: PINETREE 11-2 STD
 Project #: ROUNDEL HOMES INC

F10-A Versa-Lam LVL 2.1E 3100 SP 1.750" X 11.875" 2-Ply - PASSED

Level: Second Floor

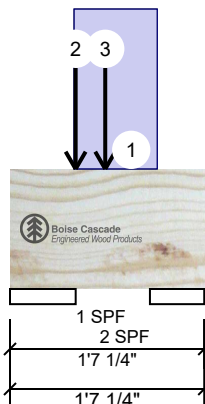
Member Information

Type:	Girder	Application:	Floor (Residential)
Plies:	2	Design Method:	LSD
Moisture Condition:	Dry	Building Code:	NBCC 2015 / OBC 2012
Deflection LL:	360	Load Sharing:	No
Deflection TL:	240	Deck:	Not Checked
Importance:	Normal - II	Vibration:	Not Checked
General Load			
Floor Live:	40 PSF		
Dead:	15 PSF		

Unfactored Reactions UNPATTERNED lb (Uplift)

Brg	Direction	Live	Dead	Snow	Wind
1	Vertical	92	274	420	0
2	Vertical	65	63	0	0

Bearings and Factored Reactions

Bearing	Length	Dir.	Cap. React	D/L lb	Total	Ld. Case	Ld. Comb.
1 - SPF	6.500"	Vert	8%	343 / 722	1065	L	1.25D+1.5S +L
2 - SPF	5.375"	Vert	7%	78 / 98	176	L	1.25D+1.5L

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	63 ft-lb	9 7/16"	29375 ft-lb	0.002 (0%)	1.25D+1.5L	L
Unbraced	63 ft-lb	9 7/16"	29375 ft-lb	0.002 (0%)	1.25D+1.5L	L
Shear	149 lb	1'6 3/8"	10970 lb	0.014 (1%)	1.25D+1.5L	L
Perm Defl in.	0.000 (L/1545523)	9 7/16"	0.025 (L/360)	0.000 (0%)	D	Uniform
LL Defl inch	0.000 (L/931451)	9 7/16"	0.025 (L/360)	0.000 (0%)	L+0.5S	L
TL Defl inch	0.000 (L/581184)	9 7/16"	0.037 (L/240)	0.000 (0%)	D+L+0.5S	L

Design Notes

- 1 Performed Secondary Bearing Check (CSA 086-14 6.5.7.3). Assumed point load size: beam width X 4.5.
- 2 Performed Secondary Bearing Check (CSA 086-14 6.5.7.3). Assumed point load size: beam width X 4.5.
- 3 Provide support to prevent lateral movement and rotation at the end bearings. Lateral support may also be required at the interior bearings by the building code.
- 4 Girders are designed to be supported on the bottom edge only.
- 5 Multiple plies must be fastened together as per manufacturer's details.
- 6 Top loads must be supported equally by all plies.
- 7 Top must be continuously laterally braced.
- 8 Bottom must have sheathing attached or be continuously braced.
- 9 Lateral slenderness ratio based on full section width.



APRIL 14, 2023

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTES: EWP-FLOORS. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

Notes

Calculated Structural Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive

chemicals

Handling & Installation

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding

Manufacturer Info

Boise Cascade Wood Products
 1111 W. Jefferson St.
 Boise, ID 83702
 (800) 232-0788
 www.bc.com
 CCMC: 12472

This design is valid until 11/3/2024

Kott Inc.
 3228 Moodie Dr, Ottawa, Ontario
 613-838-2775 / 905-642-4400



RECEIVED
 Per: Joshua Nabua





Client: GREENPARK
 Project:
 Address: PINETREE 11- 2
 RICHMOND HILL, ON

Date: 3/22/2023
 Input by: W C
 Job Name: PINETREE 11-2 STD
 Project #: ROUNDEL HOMES INC

F10-A Versa-Lam LVL 2.1E 3100 SP 1.750" X 11.875" 2-Ply - PASSED

Level: Second Floor

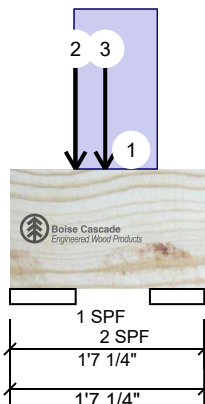

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Part. Uniform	0-6-5 to 1-2-9		Top	80 PLF	0 PLF	0 PLF	0 PLF	Wall Self Weight
2	Point	0-6-8		Top	204 lb	0 lb	420 lb	0 lb	F13 F13
	Bearing Length	0-5-8							
3	Point	0-9-7		Near Face	59 lb	157 lb	0 lb	0 lb	J4
	Self Weight				12 PLF				



APRIL 14, 2023

READ ALL NOTES ON THIS PAGE AND ON THE
 ENGINEERING NOTES: EWP-FLOORS. THE NOTE
 PAGE IS AN INTEGRAL PART OF THIS DRAWING
 AS IT CONTAINS SPECIFICATIONS AND CRITERIA
 USED IN THE DESIGN OF THIS COMPONENT.

Notes

Calculated Structural Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive

chemicals

Handling & Installation

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding

This design is valid until 11/3/2024

Manufacturer Info

Boise Cascade Wood Products
 1111 W. Jefferson St.
 Boise, ID 83702
 (800) 232-0788
 www.bc.com
 CCMC: 12472

Kott Inc.
 3228 Moodie Dr, Ottawa, Ontario
 613-838-2775 / 905-642-4400



Per: joshua.nabua





Client: GREENPARK
 Project:
 Address: PINETREE 11- 2
 RICHMOND HILL, ON

Date: 3/22/2023
 Input by: W C
 Job Name: PINETREE 11-2 STD
 Project #: ROUNDEL HOMES INC

F10-B Versa-Lam LVL 2.1E 3100 SP 1.750" X 11.875" 2-Ply - PASSED

Level: Second Floor

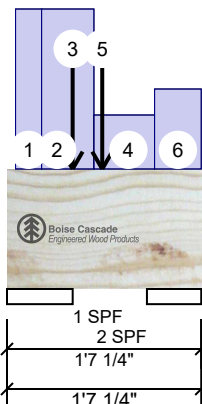
Member Information

Type:	Girder	Application:	Floor (Residential)
Plies:	2	Design Method:	LSD
Moisture Condition:	Dry	Building Code:	NBCC 2015 / OBC 2012
Deflection LL:	360	Load Sharing:	No
Deflection TL:	240	Deck:	Not Checked
Importance:	Normal - II	Vibration:	Not Checked
General Load			
Floor Live:	40 PSF		
Dead:	15 PSF		

Unfactored Reactions UNPATTERNED lb (Uplift)

Brg	Direction	Live	Dead	Snow	Wind
1	Vertical	92	319	443	0
2	Vertical	65	66	0	0

Bearings and Factored Reactions

Bearing	Length	Dir.	Cap.	React D/L lb	Total	Ld. Case	Ld. Comb.
1 - SPF	6.500"	Vert	8%	399 / 756	1155	L	1.25D+1.5S +L
2 - SPF	5.375"	Vert	7%	83 / 98	181	L	1.25D+1.5L

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	63 ft-lb	9 7/16"	28314 ft-lb	0.002 (0%)	1.25D+1.5L	L
Unbraced	63 ft-lb	9 7/16"	28314 ft-lb	0.002 (0%)	1.25D+1.5L	L
Shear	180 lb	1'6 3/8"	10574 lb	0.017 (2%)	1.25D+1.5L	L
Perm Defl in. (L/1583201)	0.000	9 7/16"	0.025 (L/360)	0.000 (0%)	D	Uniform
LL Defl inch (L/931451)	0.000	9 7/16"	0.025 (L/360)	0.000 (0%)	L+0.5S	L
TL Defl inch (L/586433)	0.000	9 7/16"	0.037 (L/240)	0.000 (0%)	D+L+0.5S	L

Design Notes

- 1 Performed Secondary Bearing Check (CSA 086-14 6.5.7.3). Assumed point load size: beam width X 4.5.
- 2 Performed Secondary Bearing Check (CSA 086-14 6.5.7.3). Assumed point load size: beam width X 4.5.
- 3 Provide support to prevent lateral movement and rotation at the end bearings. Lateral support may also be required at the interior bearings by the building code.
- 4 Girders are designed to be supported on the bottom edge only.
- 5 Multiple plies must be fastened together as per manufacturer's details.
- 6 Top loads must be supported equally by all plies.
- 7 Top must be continuously laterally braced.
- 8 Bottom must have sheathing attached or be continuously braced.
- 9 Lateral slenderness ratio based on full section width.



APRIL 14, 2023

**READ ALL NOTES ON THIS PAGE AND ON THE
 ENGINEERING NOTES: EWP-FLOORS. THE NOTE
 PAGE IS AN INTEGRAL PART OF THIS DRAWING
 AS IT CONTAINS SPECIFICATIONS AND CRITERIA
 USED IN THE DESIGN OF THIS COMPONENT.**

Notes

Calculated Structural Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive

chemicals

Handling & Installation

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding

Manufacturer Info

Boise Cascade Wood Products
 1111 W. Jefferson St.
 Boise, ID 83702
 (800) 232-0788
 www.bc.com
 CCMC: 12472

This design is valid until 11/3/2024

Kott Inc.
 3228 Moodie Dr, Ottawa, Ontario
 613-838-2775 / 905-642-4400



RECEIVED
 Per: joshua.nabua





Client: GREENPARK
 Project:
 Address: PINETREE 11- 2
 RICHMOND HILL, ON

Date: 3/22/2023
 Input by: W C
 Job Name: PINETREE 11-2 STD
 Project #: ROUNDEL HOMES INC

F10-B Versa-Lam LVL 2.1E 3100 SP 1.750" X 11.875" 2-Ply - PASSED

Level: Second Floor

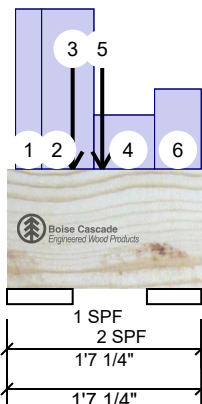

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Part. Uniform	0-0-14 to 0-3-7		Top	80 PLF	0 PLF	0 PLF	0 PLF	Wall Self Weight
2	Part. Uniform	0-3-7 to 0-8-10		Top	80 PLF	0 PLF	0 PLF	0 PLF	Wall Self Weight
3	Point	0-6-8		Top	214 lb	0 lb	443 lb	0 lb	F13 F13
	Bearing Length	0-5-8							
4	Part. Uniform	0-8-10 to 1-2-10		Top	27 PLF	0 PLF	0 PLF	0 PLF	Wall Self Weight
5	Point	0-9-7		Far Face	72 lb	157 lb	0 lb	0 lb	J4
6	Part. Uniform	1-2-10 to 1-7-4		Top	40 PLF	0 PLF	0 PLF	0 PLF	Wall Self Weight
	Self Weight				12 PLF				



APRIL 14, 2023

**READ ALL NOTES ON THIS PAGE AND ON THE
 ENGINEERING NOTES: EWP-FLOORS. THE NOTE
 PAGE IS AN INTEGRAL PART OF THIS DRAWING
 AS IT CONTAINS SPECIFICATIONS AND CRITERIA
 USED IN THE DESIGN OF THIS COMPONENT.**

Notes

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive

chemicals

Handling & Installation

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding

This design is valid until 11/3/2024

Manufacturer Info

Boise Cascade Wood Products
 1111 W. Jefferson St.
 Boise, ID 83702
 (800) 232-0788
 www.bc.com
 CCMC: 12472

Kott Inc.
 3228 Moodie Dr, Ottawa, Ontario
 613-838-2775 / 905-642-4400



RECEIVED
 Per: joshua.nabua




Client: GREENPARK
Project:
Address: PINETREE 11- 2
RICHMOND HILL, ON

Date:	3/22/2023
Input by:	W C
Job Name:	PINETREE 11-2 STD
Project #:	ROUNDEL HOMES INC

F11-A	Versa-Lam LVL 2.1E 3100 SP	1.750" X 11.875"	2-Ply - PASSED
-------	----------------------------	------------------	----------------

Level: Second Floor

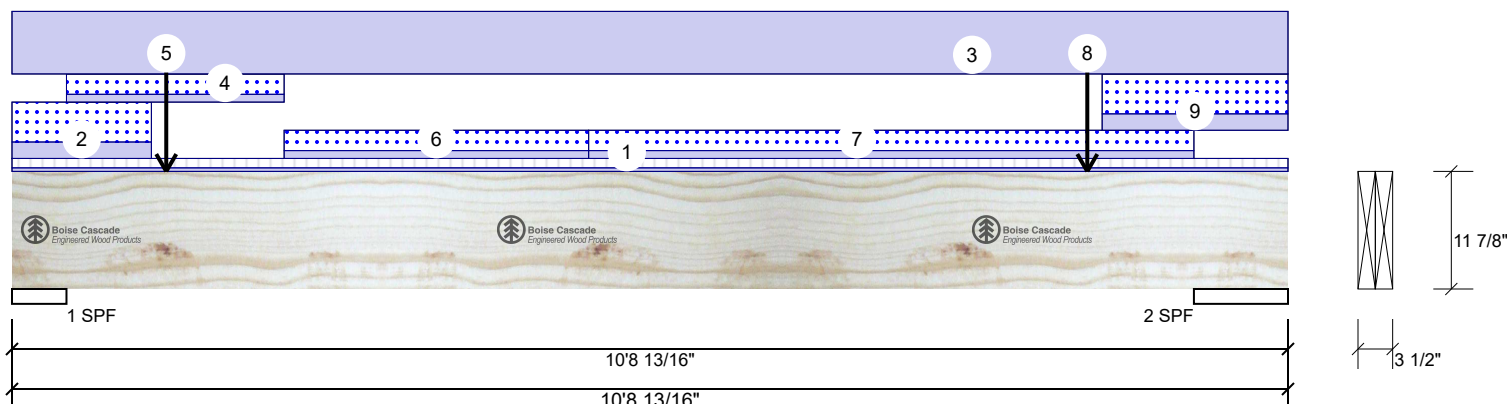

Member Information

Type:	Girder	Application:	Floor (Residential)
Plies:	2	Design Method:	LSD
Moisture Condition:	Dry	Building Code:	NBCC 2015 / OBC 2012
Deflection LL:	360	Load Sharing:	No
Deflection TL:	240	Deck:	Not Checked
Importance:	Normal - II	Vibration:	Not Checked
General Load			
Floor Live:	40 PSF		
Dead:	15 PSF		

Unfactored Reactions UNPATTERNED Ib (Uplift)

Brg	Direction	Live	Dead	Snow	Wind
1	Vertical	63	722	389	0
2	Vertical	67	761	406	0

Bearings and Factored Reactions

Bearing	Length	Dir.	Cap.	React D/L lb	Total	Ld. Case	Ld. Comb.
1 - SPF	5.500"	Vert	15%	903 / 483	1385	L	1.25D+1.5L +S
2 - SPF	9.500"	Vert	9%	951 / 506	1456	L	1.25D+1.5L +S

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	2431 ft-lb	5'2 5/8"	27606 ft-lb	0.088 (9%)	1.25D+1.5L +S	L
Unbraced	2431 ft-lb	5'2 5/8"	27606 ft-lb	0.088 (9%)	1.25D+1.5L +S	L
Shear	1029 lb	8'11 7/16"	10309 lb	0.100 (10%)	1.25D+1.5L +S	L
Perm Defl in.	0.023 (L/5003)	5'2 7/16"	0.320 (L/360)	0.072 (7%)	D	Uniform
LL Defl inch	0.010 (L/11400)	5'2 9/16"	0.320 (L/360)	0.032 (3%)	S+0.5L	L
TL Defl inch	0.033 (L/3477)	5'2 1/2"	0.481 (L/240)	0.069 (7%)	D+S+0.5L	L



APRIL 14, 2023

Design Notes

- 1 Provide support to prevent lateral movement and rotation at the end bearings. Lateral support may also be required at the interior bearings by the building code.
- 2 Girders are designed to be supported on the bottom edge only.
- 3 Multiple plies must be fastened together as per manufacturer's details.
- 4 Top loads must be supported equally by all plies.
- 5 Top must be continuously laterally braced.
- 6 Bottom must be laterally braced at bearings.
- 7 Lateral slenderness ratio based on full section width.

**READ ALL NOTES ON THIS PAGE AND ON THE
ENGINEERING NOTES: EWP-FLOORS. THE NOTE
PAGE IS AN INTEGRAL PART OF THIS DRAWING
AS IT CONTAINS SPECIFICATIONS AND CRITERIA
USED IN THE DESIGN OF THIS COMPONENT.**

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Tie-In	0-0-0 to 10-8-13	0-3-10	Top	15 PSF	40 PSF	0 PSF	0 PSF	
2	Part. Uniform	0-0-0 to 1-2-1		Top	21 PLF	0 PLF	51 PLF	0 PLF	
3	Part. Uniform	0-0-0 to 10-8-13		Top	80 PLF	0 PLF	0 PLF	0 PLF	Wall Self Weight

Continued on page 2...

Notes

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive

chemicals

Handling & Installation

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding

Manufacturer Info

Boise Cascade Wood Products
1111 W. Jefferson St.
Boise, ID 83702
(800) 232-0788
www.bc.com
CCMC: 12472

This design is valid until 11/3/2024

Kott Inc.
3228 Moodie Dr, Ottawa, Ontario
613-838-2775 / 905-642-4400

05/24/2023



RECEIVED
CSD | DRAW | DESIGN
BUILD
Per: joshua.nabua




Client: GREENPARK
 Project:
 Address: PINETREE 11- 2
 RICHMOND HILL, ON

Date: 3/22/2023
 Input by: W C
 Job Name: PINETREE 11-2 STD
 Project #: ROUNDEL HOMES INC

Page 17 of 23

F11-A Versa-Lam LVL 2.1E 3100 SP 1.750" X 11.875" 2-Ply - PASSED

Level: Second Floor

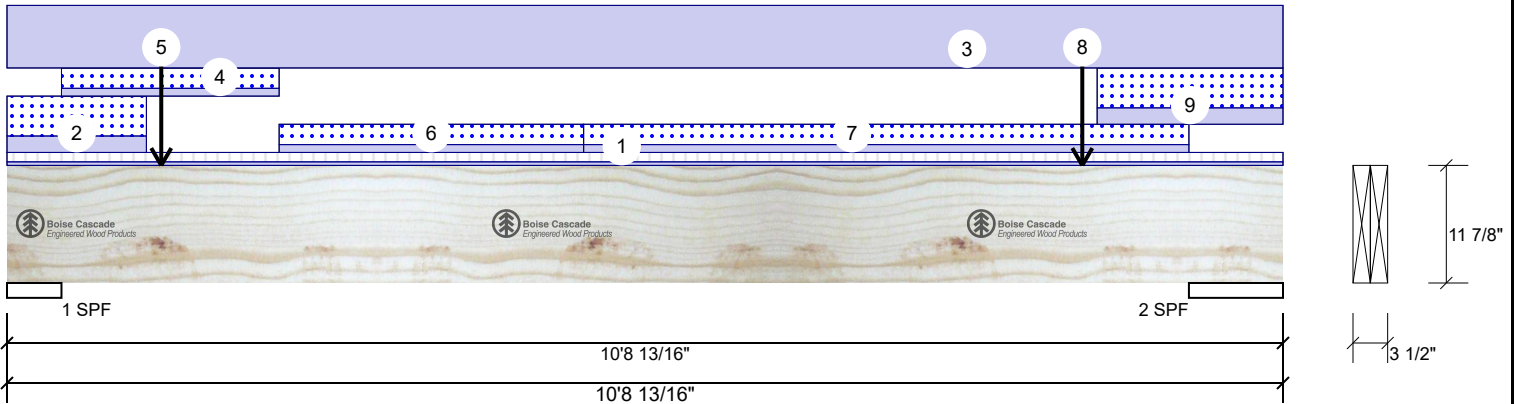

...Continued from page 1

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
4	Part. Uniform	0-5-8 to 2-3-8		Top	10 PLF	0 PLF	26 PLF	0 PLF	
5	Point	1-3-9		Top	148 lb	0 lb	204 lb	0 lb	Header Column
	Bearing Length	0-5-8							
6	Part. Uniform	2-3-8 to 4-10-4		Top	10 PLF	0 PLF	26 PLF	0 PLF	
7	Part. Uniform	4-10-4 to 9-11-5		Top	10 PLF	0 PLF	26 PLF	0 PLF	
8	Point	9-0-9		Top	148 lb	0 lb	204 lb	0 lb	Header Column
	Bearing Length	0-5-8							
9	Part. Uniform	9-2-1 to 10-8-13		Top	21 PLF	0 PLF	51 PLF	0 PLF	
	Self Weight				12 PLF				



APRIL 14, 2023

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTES: EWP-FLOORS. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

Notes

Calculated Structural Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive chemicals

Handling & Installation

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding

This design is valid until 11/3/2024

Manufacturer Info

Boise Cascade Wood Products
 1111 W. Jefferson St.
 Boise, ID 83702
 (800) 232-0788
 www.bc.com
 CCMC: 12472

Kott Inc.
 3228 Moodie Dr, Ottawa, Ontario
 613-838-2775 905-642-4400



Per: joshua.nabua





Client: GREENPARK
Project:
Address: PINETREE 11- 2
RICHMOND HILL, ON

Date: 3/22/2023
Input by: W C
Job Name: PINETREE 11-2 STD
Project #: ROUNDEL HOMES INC

F5-A Versa-Lam LVL 2.1E 3100 SP 1.750" X 11.875" - PASSED

Level: Second Floor

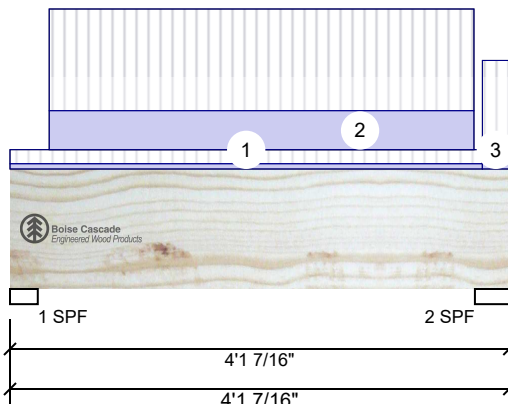

Member Information

Type:	Girder	Application:	Floor (Residential)
Plies:	1	Design Method:	LSD
Moisture Condition:	Dry	Building Code:	NBCC 2015 / OBC 2012
Deflection LL:	360	Load Sharing:	No
Deflection TL:	240	Deck:	Not Checked
Importance:	Normal - II	Vibration:	Not Checked
General Load			
Floor Live:	40 PSF		
Dead:	15 PSF		

Unfactored Reactions UNPATTERNED lb (Uplift)

Brg	Direction	Live	Dead	Snow	Wind
1	Vertical	120	58	0	0
2	Vertical	133	63	0	0

Bearings and Factored Reactions

Bearing	Length	Dir.	Cap.	React D/L lb	Total	Ld. Case	Ld. Comb.
1 - SPF	2.750"	Vert	8%	72 / 179	251	L	1.25D+1.5L
2 - SPF	3.403"	Vert	8%	79 / 200	279	L	1.25D+1.5L

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	247 ft-lb	2' 3/8"	17696 ft-lb	0.014 (1%)	1.25D+1.5L	L
Unbraced	247 ft-lb	2' 3/8"	17696 ft-lb	0.014 (1%)	1.25D+1.5L	L
Shear	123 lb	1'2 5/8"	6608 lb	0.019 (2%)	1.25D+1.5L	L
Perm Defl in. (L/149068)	0.000	2' 7/16"	0.124 (L/360)	0.002 (0%)	D	Uniform
LL Defl inch (L/69963)	0.001	2' 7/16"	0.124 (L/360)	0.005 (1%)	L	L
TL Defl inch (L/47616)	0.001	2' 7/16"	0.186 (L/240)	0.005 (1%)	D+L	L



APRIL 14, 2023

Design Notes

- 1 Provide support to prevent lateral movement and rotation at the end bearings. Lateral support may also be required at the interior bearings by the building code.
- 2 Girders are designed to be supported on the bottom edge only.
- 3 Top must be continuously laterally braced.
- 4 Bottom must be laterally braced at bearings.

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTES: EWP-FLOORS. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Tie-In	0-0-0 to 3-10-12	0-2-8	Top	15 PSF	40 PSF	0 PSF	0 PSF	
2	Part. Uniform	0-3-14 to 3-9-15		Top	23 PLF	60 PLF	0 PLF	0 PLF	
3	Tie-In	3-10-12 to 4-1-7	1-2-0	Top	15 PSF	40 PSF	0 PSF	0 PSF	
	Self Weight				6 PLF				

Notes

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive chemicals

chemicals

Handling & Installation

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding

Manufacturer Info

Boise Cascade Wood Products
1111 W. Jefferson St.
Boise, ID 83702
(800) 232-0788
www.bc.com
CCMC: 12472

This design is valid until 11/3/2024

Kott Inc.
3228 Moodie Dr, Ottawa, Ontario
613-838-2775 / 905-642-4400



Per: Joshua Nabua




Client: GREENPARK
Project:
Address: PINETREE 11- 2
RICHMOND HILL, ON

Date: 3/22/2023
Input by: W C
Job Name: PINETREE 11-2 STD
Project #: ROUNDEL HOMES INC

F6-A Versa-Lam LVL 2.1E 3100 SP 1.750" X 11.875" 2-Ply - PASSED

Level: Second Floor

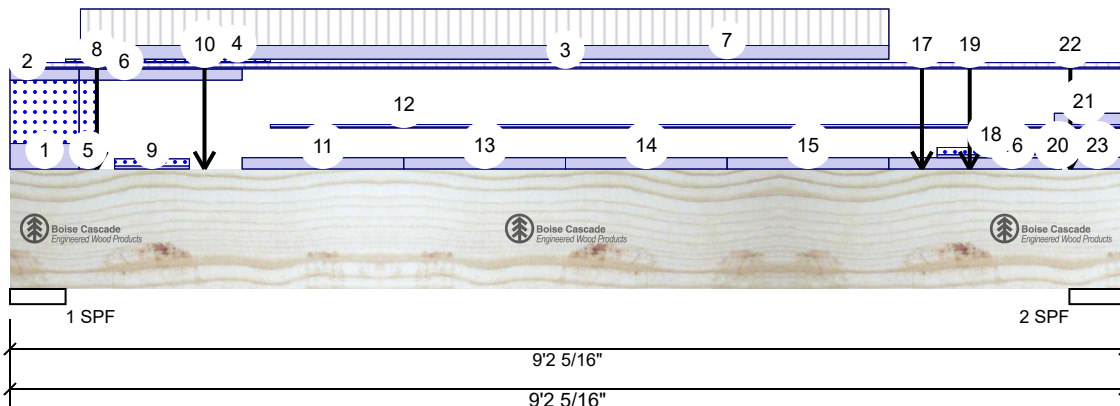
Member Information

Type:	Girder	Application:	Floor (Residential)
Plies:	2	Design Method:	LSD
Moisture Condition:	Dry	Building Code:	NBCC 2015 / OBC 2012
Deflection LL:	360	Load Sharing:	No
Deflection TL:	240	Deck:	Not Checked
Importance:	Normal - II	Vibration:	Not Checked
General Load			
Floor Live:	40 PSF		
Dead:	15 PSF		

Unfactored Reactions UNPATTERNED lb (Uplift)

Brg	Direction	Live	Dead	Snow	Wind
1	Vertical	1182	2232	2589	0
2	Vertical	1454	1666	1410	0

Bearings and Factored Reactions

Bearing	Length	Dir.	Cap.	React D/L lb	Total	Ld. Case	Ld. Comb.
1 - SPF	5.500"	Vert	66%	2789 / 5065	7854	L	1.25D+1.5S +L
2 - SPF	5.500"	Vert	48%	2083 / 3590	5673	L	1.25D+1.5L +S

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	7287 ft-lb	4'4 15/16"	35392 ft-lb	0.206 (21%)	1.25D+1.5L +S	L
Unbraced	7287 ft-lb	4'4 15/16"	35392 ft-lb	0.206 (21%)	1.25D+1.5L +S	L
Shear	3545 lb	7'8 15/16"	13217 lb	0.268 (27%)	1.25D+1.5L +S	L
Perm Defl in.	0.028 (L/3566)	4'6 1/2"	0.280 (L/360)	0.101 (10%)	D	Uniform
LL Defl inch	0.038 (L/2680)	4'6 5/8"	0.280 (L/360)	0.134 (13%)	L+0.5S	L
TL Defl inch	0.066 (L/1530)	4'6 9/16"	0.420 (L/240)	0.157 (16%)	D+L+0.5S	L

Design Notes

- 1 Performed Secondary Bearing Check (CSA 086-14 6.5.7.3). Assumed point load size: beam width X 4.5.
- 2 Performed Secondary Bearing Check (CSA 086-14 6.5.7.3). Assumed point load size: beam width X 4.5.
- 3 Provide support to prevent lateral movement and rotation at the end bearings. Lateral support may also be required at the interior bearings by the building code.
- 4 Girders are designed to be supported on the bottom edge only.
- 5 Multiple plies must be fastened together as per manufacturer's details.
- 6 Top loads must be supported equally by all plies.
- 7 Top must be continuously laterally braced.
- 8 Bottom must have sheathing attached or be continuously braced.
- 9 Lateral slenderness ratio based on full section width.



APRIL 14, 2023

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTES: EWP-FLOORS. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

Notes

Calculated Structural Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive

chemicals

Handling & Installation

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding

This design is valid until 11/3/2024

Manufacturer Info

Boise Cascade Wood Products
1111 W. Jefferson St.
Boise, ID 83702
(800) 232-0788
www.bc.com
CCMC: 12472

Kott Inc.
3228 Moodie Dr, Ottawa, Ontario
613-838-2775 / 905-642-4400



Per: Joshua Nabua




Client: GREENPARK
Project:
Address: PINETREE 11- 2
RICHMOND HILL, ON

Date: 3/22/2023
Input by: W C
Job Name: PINETREE 11-2 STD
Project #: ROUNDEL HOMES INC

F6-A Versa-Lam LVL 2.1E 3100 SP 1.750" X 11.875" 2-Ply - PASSED

Level: Second Floor

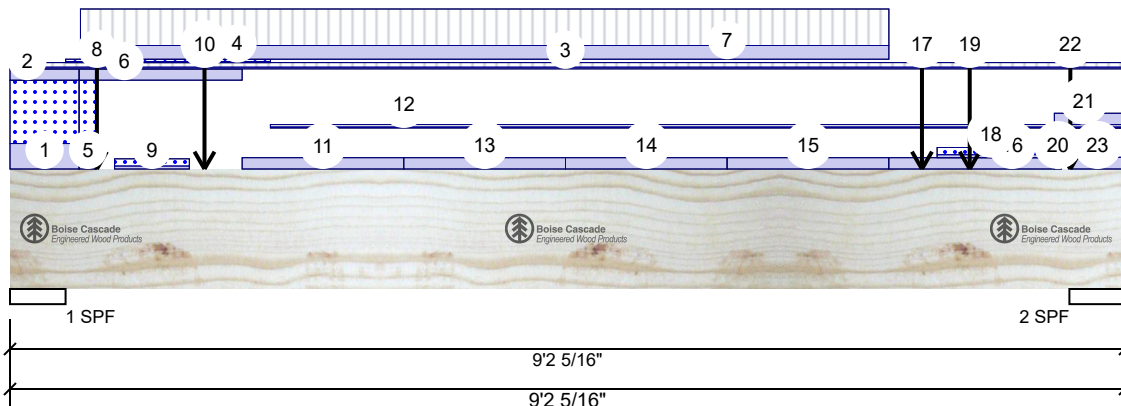

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Part. Uniform	0-0-0 to 0-6-14		Top	180 PLF	0 PLF	448 PLF	0 PLF	
2	Part. Uniform	0-0-0 to 0-6-14		Top	80 PLF	0 PLF	0 PLF	0 PLF	Wall Self Weight
3	Tie-In	0-1-2 to 9-2-5	0-9-10	Top	15 PSF	40 PSF	0 PSF	0 PSF	
4	Part. Uniform	0-5-8 to 2-1-12		Top	7 PLF	0 PLF	17 PLF	0 PLF	
5	Part. Uniform	0-6-14 to 0-8-10		Top	180 PLF	0 PLF	448 PLF	0 PLF	
6	Part. Uniform	0-6-14 to 1-11-0		Top	80 PLF	0 PLF	0 PLF	0 PLF	Wall Self Weight
7	Part. Uniform	0-7-0 to 7-3-0		Far Face	97 PLF	258 PLF	0 PLF	0 PLF	
8	Point	0-8-10		Top	1123 lb	0 lb	2089 lb	0 lb	F14 F14
	Bearing Length	0-5-8							
9	Part. Uniform	0-10-6 to 1-5-12		Top	21 PLF	0 PLF	51 PLF	0 PLF	
10	Point	1-7-4		Top	114 lb	0 lb	157 lb	0 lb	Header Column
	Bearing Length	0-5-8							
11	Part. Uniform	1-11-0 to 3-3-0		Top	80 PLF	0 PLF	0 PLF	0 PLF	Wall Self Weight
12	Part. Uniform	2-1-12 to 9-2-5		Top	7 PLF	0 PLF	17 PLF	0 PLF	
13	Part. Uniform	3-3-0 to 4-7-0		Top	80 PLF	0 PLF	0 PLF	0 PLF	Wall Self Weight
14	Part. Uniform	4-7-0 to 5-11-0		Top	80 PLF	0 PLF	0 PLF	0 PLF	Wall Self Weight
15	Part. Uniform	5-11-0 to 7-3-0		Top	80 PLF	0 PLF	0 PLF	0 PLF	Wall Self Weight
16	Part. Uniform	7-3-0 to 8-7-6		Top	80 PLF	0 PLF	0 PLF	0 PLF	Wall Self Weight
17	Point	7-6-4		Top	114 lb	0 lb	157 lb	0 lb	Header Column
	Bearing Length	0-5-8							
18	Part. Uniform	7-7-12 to 8-7-6		Top	21 PLF	0 PLF	51 PLF	0 PLF	
19	Point	7-11-0		Far Face	132 lb	352 lb	0 lb	0 lb	J9
20	Part. Uniform	8-7-6 to 8-8-1		Top	21 PLF	0 PLF	51 PLF	0 PLF	
21	Part. Uniform	8-7-6 to 9-2-5		Top	80 PLF	0 PLF	0 PLF	0 PLF	Wall Self W.
22	Point	8-8-15		Top	552 lb	271 lb	949 lb	0 lb	F15 F15
	Bearing Length	0-5-8							
23	Part. Uniform	8-8-15 to 9-2-5		Top	83 PLF	0 PLF	207 PLF	0 PLF	
	Self Weight				12 PLF				



APRIL 14, 2023

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTES: EWP-FLOORS. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

Notes

Calculated Structural Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive

chemicals

Handling & Installation

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding

This design is valid until 11/3/2024

Manufacturer Info

Boise Cascade Wood Products
1111 W. Jefferson St.
Boise, ID 83702
(800) 232-0788
www.bc.com
CCMC: 12472

Kott Inc.
3228 Moodie Dr, Ottawa, Ontario
613-838-2775 / 905-642-4400



RECEIVED
Per: joshua.nabua





Client: GREENPARK
Project:
Address: PINETREE 11- 2
RICHMOND HILL, ON

Date: 3/22/2023
Input by: W C
Job Name: PINETREE 11-2 STD
Project #: ROUNDEL HOMES INC

F6-B Versa-Lam LVL 2.1E 3100 SP 1.750" X 11.875" 2-Ply - PASSED

Level: Second Floor

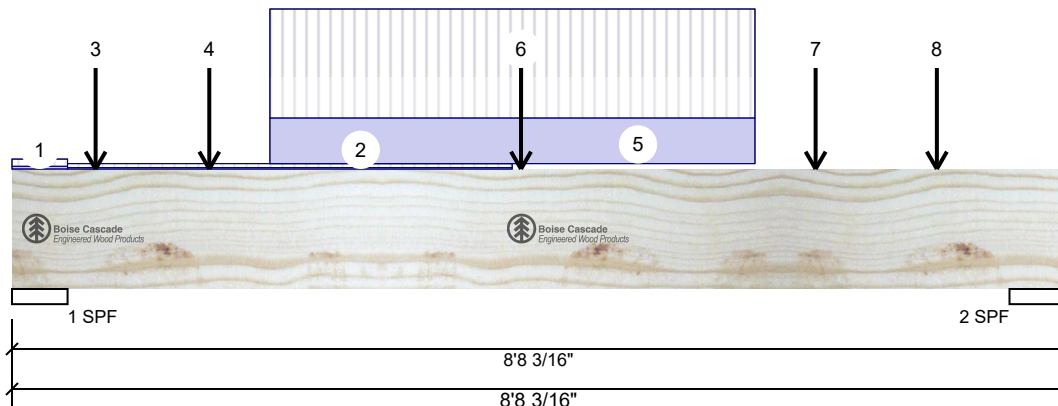
Member Information

Type:	Girder	Application:	Floor (Residential)
Plies:	2	Design Method:	LSD
Moisture Condition:	Dry	Building Code:	NBCC 2015 / OBC 2012
Deflection LL:	360	Load Sharing:	No
Deflection TL:	240	Deck:	Not Checked
Importance:	Normal - II	Vibration:	Not Checked
General Load			
Floor Live:	40 PSF		
Dead:	15 PSF		

Unfactored Reactions UNPATTERNED lb (Uplift)

Brg	Direction	Live	Dead	Snow	Wind
1	Vertical	1316	598	0	0
2	Vertical	1344	593	0	0

Bearings and Factored Reactions

Bearing	Length	Dir.	Cap.	React D/L lb	Total	Ld. Case	Ld. Comb.
1 - SPF	5.500"	Vert	23%	748 / 1974	2721	L	1.25D+1.5L
2 - SPF	5.500"	Vert	23%	742 / 2016	2757	L	1.25D+1.5L

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	5593 ft-lb	4'2 13/16"	35392 ft-lb	0.158 (16%)	1.25D+1.5L	L
Unbraced	5593 ft-lb	4'2 13/16"	35392 ft-lb	0.158 (16%)	1.25D+1.5L	L
Shear	2751 lb	7'2 13/16"	13217 lb	0.208 (21%)	1.25D+1.5L	L
Perm Defl in.	0.014 (L/6992)	4'4 1/16"	0.263 (L/360)	0.051 (5%)	D	Uniform
LL Defl inch	0.030 (L/3143)	4'4 1/8"	0.263 (L/360)	0.115 (11%)	L	L
TL Defl inch	0.044 (L/2168)	4'4 1/8"	0.395 (L/240)	0.111 (11%)	D+L	L

Design Notes

- 1 Provide support to prevent lateral movement and rotation at the end bearings. Lateral support may also be required at the interior bearings by the building code.
- 2 Girders are designed to be supported on the bottom edge only.
- 3 Multiple plies must be fastened together as per manufacturer's details.
- 4 Top loads must be supported equally by all plies.
- 5 Top must be continuously laterally braced.
- 6 Bottom must have sheathing attached or be continuously braced.
- 7 Lateral slenderness ratio based on full section width.



APRIL 14, 2023

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTES: EWP-FLOORS. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Tie-In	0-0-0 to 0-5-8	0-6-7	Top	15 PSF	40 PSF	0 PSF	0 PSF	
2	Tie-In	0-5-8 to 4-1-8	0-3-8	Top	15 PSF	40 PSF	0 PSF	0 PSF	
3	Point	0-8-4		Near Face	78 lb	190 lb	0 lb	0 lb	J6
4	Point	1-7-8		Near Face	132 lb	315 lb	0 lb	0 lb	J6
5	Part. Uniform	2-1-8 to 6-1-8		Near Face	136 PLF	325 PLF	0 PLF	0 PLF	

Continued on page 2...

Notes

Calculated Structural Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive

chemicals

Handling & Installation

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding

This design is valid until 11/3/2024

Manufacturer Info

Boise Cascade Wood Products
1111 W. Jefferson St.
Boise, ID 83702
(800) 232-0788
www.bc.com
CCMC: 12472

Kott Inc.
3228 Moodie Dr, Ottawa, Ontario
613-838-2775 905-642-4400



Per: joshua.nabua





Client: GREENPARK
 Project:
 Address: PINETREE 11- 2
 RICHMOND HILL, ON

Date: 3/22/2023
 Input by: W C
 Job Name: PINETREE 11-2 STD
 Project #: ROUNDEL HOMES INC

Page 22 of 23

F6-B Versa-Lam LVL 2.1E 3100 SP 1.750" X 11.875" 2-Ply - PASSED

Level: Second Floor

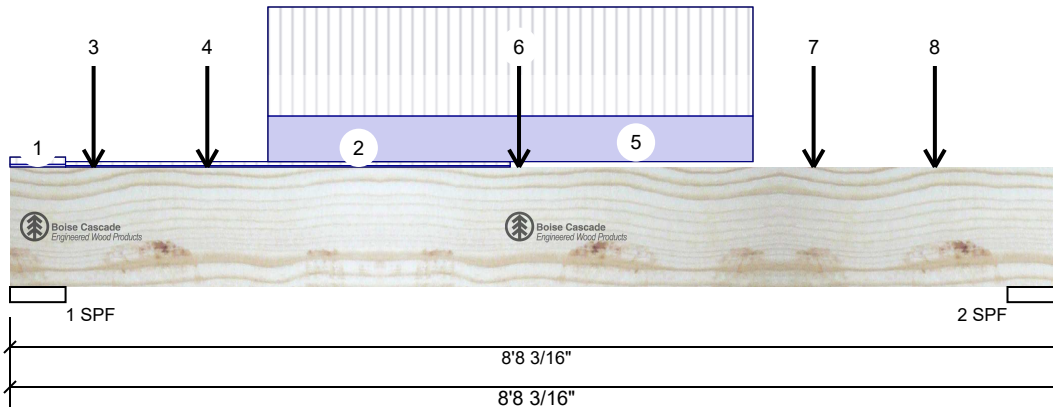

...Continued from page 1

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
6	Point	4-2-6		Far Face	34 lb	71 lb	0 lb	0 lb	F9
7	Point	6-7-8		Near Face	129 lb	325 lb	0 lb	0 lb	J6
8	Point	7-7-8		Near Face	152 lb	406 lb	0 lb	0 lb	J6
	Self Weight				12 PLF				



APRIL 14, 2023

READ ALL NOTES ON THIS PAGE AND ON THE
 ENGINEERING NOTES: EWP-FLOORS. THE NOTE
 PAGE IS AN INTEGRAL PART OF THIS DRAWING
 AS IT CONTAINS SPECIFICATIONS AND CRITERIA
 USED IN THE DESIGN OF THIS COMPONENT.

Notes

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive

chemicals

Handling & Installation

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding

This design is valid until 11/3/2024

Manufacturer Info

Boise Cascade Wood Products
 1111 W. Jefferson St.
 Boise, ID 83702
 (800) 232-0788
 www.bc.com
 CCMC: 12472

Kott Inc.
 3228 Moodie Dr, Ottawa, Ontario
 613-838-2775 905-642-4400



Per: joshua.nabua





Client: GREENPARK
Project:
Address: PINETREE 11- 2
RICHMOND HILL, ON

Date: 3/22/2023
Input by: W C
Job Name: PINETREE 11-2 STD
Project #: ROUNDEL HOMES INC

F9-A Versa-Lam LVL 2.1E 3100 SP 1.750" X 11.875" - PASSED

Level: Second Floor

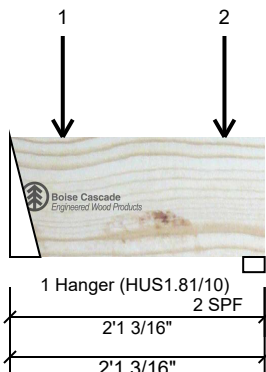

Member Information

Type:	Girder	Application:	Floor (Residential)
Plies:	1	Design Method:	LSD
Moisture Condition:	Dry	Building Code:	NBCC 2015 / OBC 2012
Deflection LL:	360	Load Sharing:	No
Deflection TL:	240	Deck:	Not Checked
Importance:	Normal - II	Vibration:	Not Checked
General Load			
Floor Live:	40 PSF		
Dead:	15 PSF		

Unfactored Reactions UNPATTERNED lb (Uplift)

Brg	Direction	Live	Dead	Snow	Wind
1	Vertical	71	34	0	0
2	Vertical	69	32	0	0

Bearings and Factored Reactions

Bearing	Length	Dir.	Cap.	React D/L lb	Total	Ld. Case	Ld. Comb.
1 - Hanger	3.000"	Vert	3%	42 / 107	149	L	1.25D+1.5L
2 - SPF	2.125"	Vert	6%	40 / 103	143	L	1.25D+1.5L

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	36 ft-lb	6 1/2"	17696 ft-lb	0.002 (0%)	1.25D+1.5L	L
Unbraced	36 ft-lb	6 1/2"	17696 ft-lb	0.002 (0%)	1.25D+1.5L	L
Shear	147 lb	1'2 7/8"	6608 lb	0.022 (2%)	1.25D+1.5L	L
Perm Defl in. (L/1394879)	0.000	1' 3/4"	0.060 (L/360)	0.000 (0%)	D	Uniform
LL Defl inch (L/711201)	0.000	1' 11/16"	0.060 (L/360)	0.001 (0%)	L	L
TL Defl inch (L/471043)	0.000	1' 11/16"	0.090 (L/240)	0.001 (0%)	D+L	L



APRIL 14, 2023

Design Notes

- Provide support to prevent lateral movement and rotation at the end bearings. Lateral support may also be required at the interior bearings by the building code.
- Fill all hanger nailing holes.
- Girders are designed to be supported on the bottom edge only.
- Top must be continuously laterally braced.
- Bottom must have sheathing attached or be continuously braced.

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTES: EWP-FLOORS. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Point	0-5-4		Far Face	28 lb	73 lb	0 lb	0 lb	J8
2	Point	1-9-4		Far Face	25 lb	67 lb	0 lb	0 lb	J8
	Self Weight				6 PLF				

Notes

Calculated Structural Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

- Dry service conditions, unless noted otherwise
- LVL not to be treated with fire retardant or corrosive

chemicals

Handling & Installation

- LVL beams must not be cut or drilled
- Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
- Damaged Beams must not be used
- Design assumes top edge is laterally restrained
- Provide lateral support at bearing points to avoid lateral displacement and rotation

- For flat roofs provide proper drainage to prevent ponding

This design is valid until 11/3/2024

Manufacturer Info

Boise Cascade Wood Products
1111 W. Jefferson St.
Boise, ID 83702
(800) 232-0788
www.bc.com
CCMC: 12472

Kott Inc.
3228 Moodie Dr, Ottawa, Ontario
613-838-2775 / 905-642-4400



Per: Joshua Nabua