


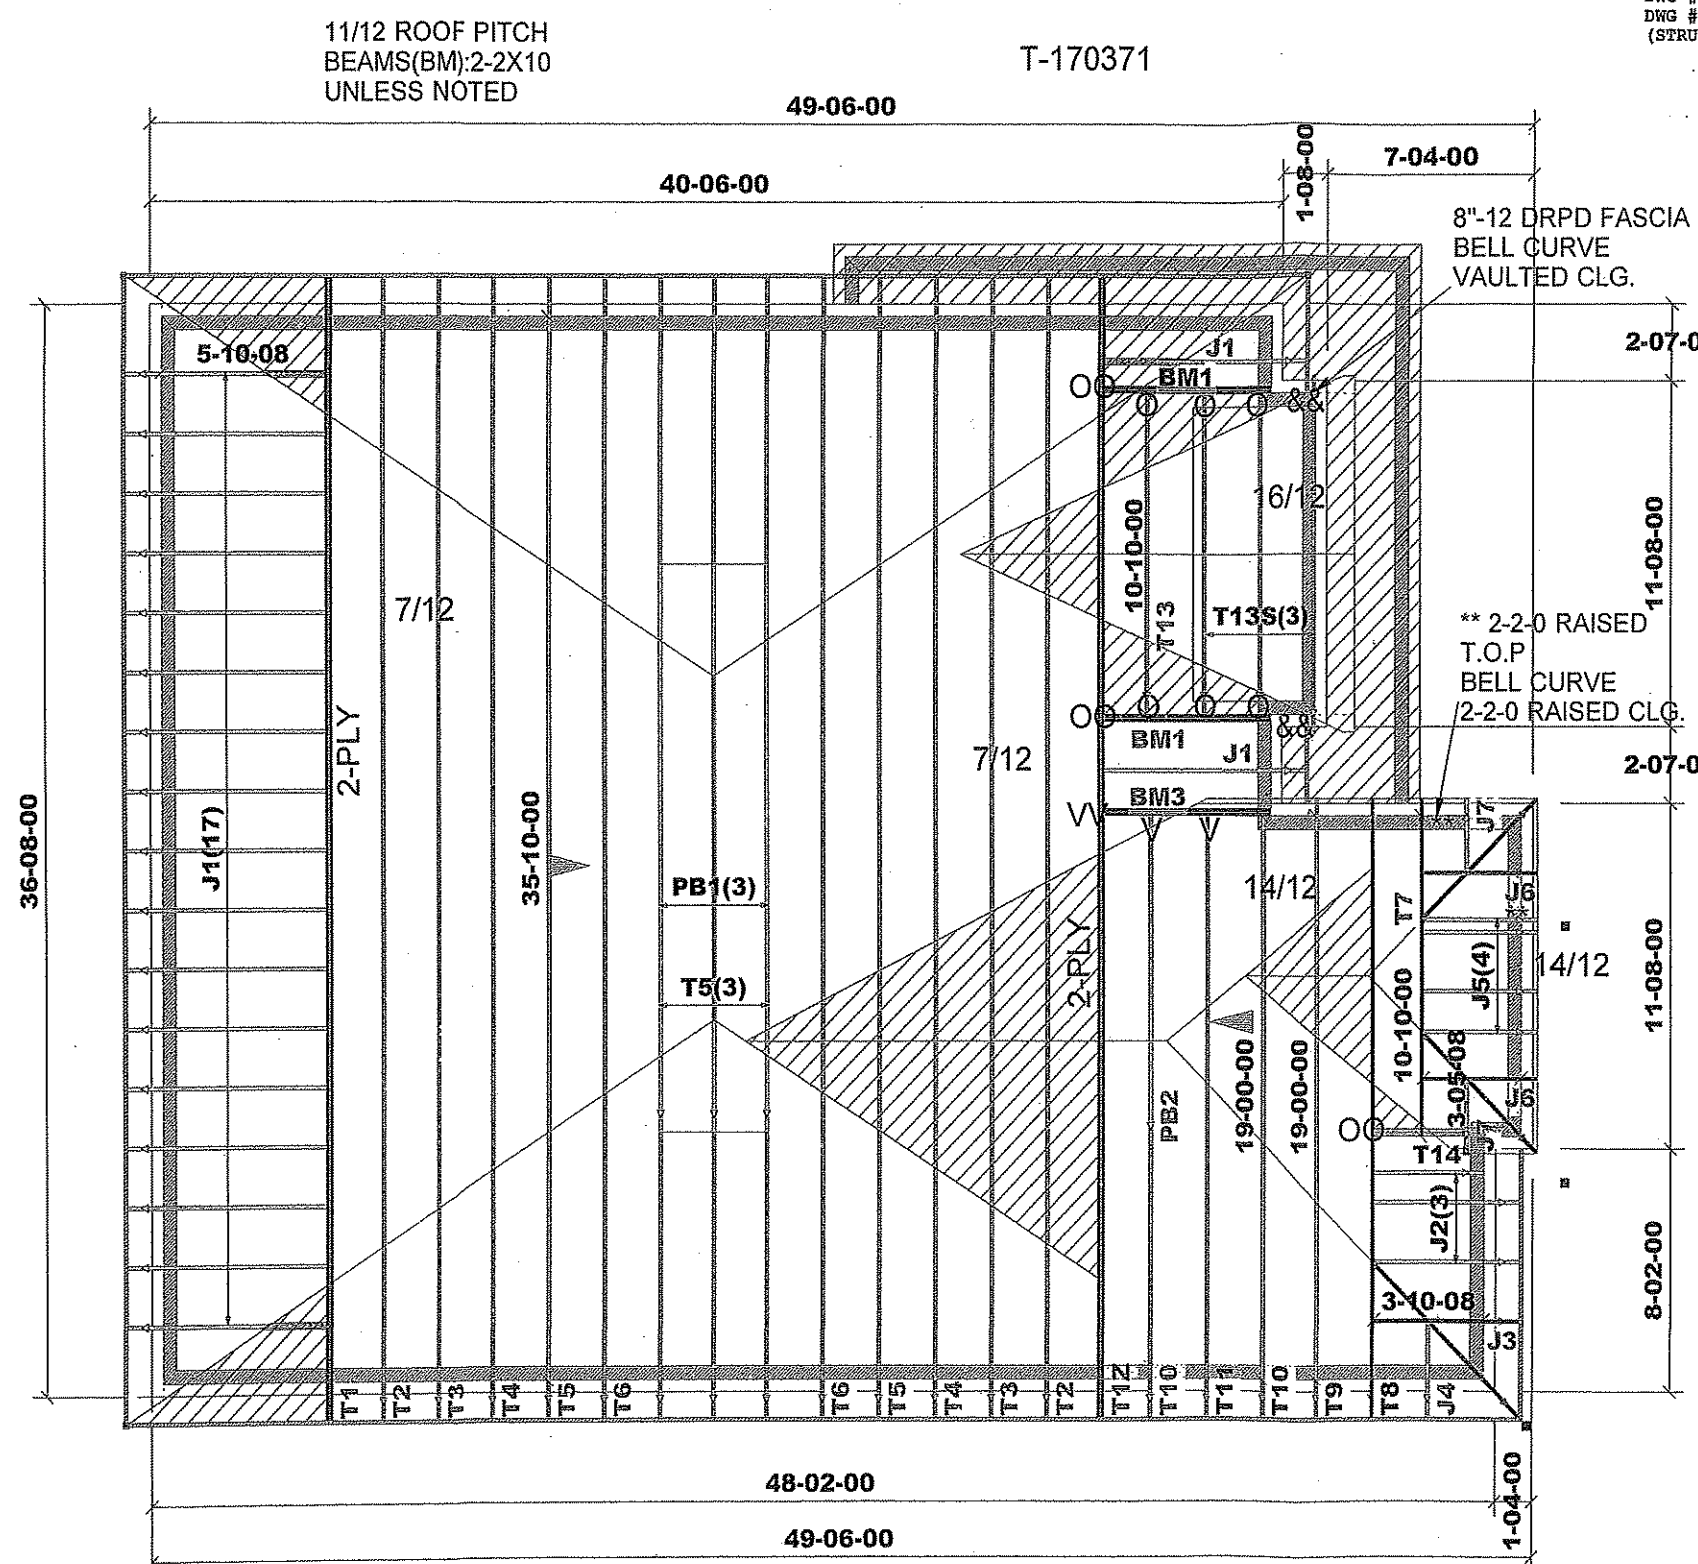

MAY 24, 2017  
THE FOLLOWING DRAWING NUMBERS REPRESENT THE IDENTIFIERS OF THE SEALED DRAWINGS OF THE TRUSS COMPONENTS IDENTIFIED ON THIS LAYOUT:  
(LAYOUT:44269/282361)  
DWG #TAM25668-17 THROUGH DWG #TAM25684-17, INCLUSIVE, AND ALL DATED 5-24-17;  
DWG #TAM6305-14 DATED 3-05-14 (CONVENTIONAL FRAMED VALLEY STANDARD)  
(STRUCTURAL COMPONENTS ONLY)

12" FINISH O.H.  
R.T.M.C  
2X6 EXTERIOR WALLS  
ASPHALT SHINGLES  
2X6 FASCIA BOARD

ALL CONVENTIONAL ROOF FRAMING TO CONFORM TO PART9 OF THE OBC. LATEST EDITION ROOF RAFTERS THAT MEET OR CROSS OVER TRUSSES ARE TO BE 2"X4"SPF @24"o.c.WITH A 2"X4"SPF VERTICAL POST TO THE TRUSS UNDER AT EACH CROSS POINT.POSTS LONGER THAN 6' TO BE Laterally BRACED SO THAT THE DISTANCE BETWEEN END POINTS AND BETWEEN ROWS OF BRACING DOES NOT EXCEED 6'.

DESIGN CONFORMS WITH THE RELEVANT SECTION OF THE LATEST EDITION OF O.B.C. PART.9

DESIGN LOADS:  
GROUND SNOW LOAD  
S<sub>s</sub>= 1.5 kPa  
TC DEAD 3 PSF  
BC LIVE 10.5 PSF  
BC DEAD 7 PSF

DENOTES CONVENTIONAL FRAMING

HARDWARE  
LUS24(O)  
LUS24-2(OO)  
LUS26-2(VV)  
LJS26DS(V)

DATE: 5-24-17  
BCIN:26064; FIRM:BCIN #29991  
ENGINEERING ONLY-DIMENSIONS TO BE VERIFIED ON SITE

SUPPORTING STRUCTURE TO BE REVIEWED AND VERIFIED BY QUALIFIED BUILDING DESIGNER  
ALL CONVENTIONAL FRAMING TO BE SPECIFIED, REVIEWED, AND CONFIRMED BY BUILDING DESIGNER PRIOR TO TRUSS INSTALLATION. ALL NOTES DESIGNATING PER PLAN WORK DO NOT REPRESENT A PART OF THE SCOPE OF THIS SEAL. THIS WORK IS DELEGATED TO A QUALIFIED BUILDING DESIGNER HAVING RESPONSIBILITY FOR THIS PROJECT.  
ALL BEAMS NOT ADDRESSED IN THIS DESCRIPTION AND LABELLED ON THIS LAYOUT ARE BEAMS SPECIFIED BY THE BUILDING DESIGNER AND/OR PROJECT ENGINEER AND ARE TO BE REVIEWED AND CONFIRMED BY THE SAME DESIGNERS PRIOR TO FABRICATION TO ENSURE ADEQUATE LOAD CAPACITY WITH RESPECT TO THE ROOF TRUSS COMPONENTS REVIEWED IN THIS SUBMISSION.

LOT SPECIFIC SCHEDULE 1 REQUIRED FOR EACH INDIVIDUAL LOT.

DWG #TAM THROUGH DWG #TAM, INCLUSIVE, DATED ;

STRUCTURAL COMPONENTS ONLY; THIS LAYOUT MUST BE READ TOGETHER WITH REFERENCED TRUSS COMPONENT DRAWINGS ANDSEALED HARDWARE DRAWINGS. HANGERS AND HARDWARE SPECIFIED ON THIS LAYOUT ONLY. REFER TO ATTACHED SEALED REFERENCED DRAWINGS FOR ADDITIONAL BRACING REQUIREMENTS:  
(IF BRACING IS SHOWN TO BE REQUIRED PROVIDE THE FOLLOWING BRACING):

PROVIDE 1 ROW OF 2 X 4 #2 SPF CONTINUOUS LATERAL BRACES ALONG WEB MEMBERS SPECIFIED ON REFERENCED SEALED TRUSS COMPONENT DRAWINGS USING 2 - 3-1/4" COMMON WIRE NAILS PER WEB MEMBER. THEN PROVIDE 2 X 4 #2 SPF "X-BRACING" ALONG THESE SAME WEB MEMBERS AT LOCATIONS INDICATED (") USING THE SAME NAILING. PROVIDE BLOCKING IF REQUIRED (DO NOT ARCH BRACING).  
PROVIDE 2 X 4 #2 SPF T-BRACE ALONG FULL LENGTH OF LATERALLY BRACED WEB MEMBERS OF 1 PLY TRUSSES COMPONENTS REQUIRING "T-BRACE" USING 1 ROW OF 3-1/4" COMMON WIRE NAILS AT 6" O/C. SIMILARLY PROVIDE 2 X 6 BRACE WITH 2 ROWS OF NAILING FOR 2 PLY TRUSS COMPONENTS AND 2 X 8 BRACE WITH 3 ROWS OF NAILING FOR 3 PLY TRUSS COMPONENTS.


(1) 2 X 6 #2 SPF ON FLAT OVER PLYWOOD SHEATHING.  
(2) 2 X 6 #2 SPF RIDGE BEAM SUPPORTED AT EACH END OVER BASE TRUSS COMPONENTS AND AT LOCATIONS MARKED BY "X".  
(3) 2 X 6 #2 SPF ROOF RAFTERS AT 24" O/C WITH MAXIMUM SUPPORT SPAN 6'-0" (ADD 2 X 4 VERTICAL SUPPORTS TO TRUSS BASE BELOW WHERE NECESSARY).

ALL CONVENTIONAL FRAMING TO BE DISTRIBUTED UNIFORMLY ALONG BASE TRUSS COMPONENTS. PROVIDE 2 X 4 KNEE-WALLS WHERE NECESSARY WITH STUDS AT24" O/C.

ALL CONVENTIONAL FRAMING TO CONFORM TO ONTARIO BUILDING CODE (CURRENT EDITION).

I REVIEWED AND TAKE RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF A FIRM REGISTERED UNDER SUBSECTION 3.2.5 OF THE ONTARIO BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSES AND/OR CATEGORIES.  
REGISTERED FIRM: MICRO CITY ENGINEERING SERVICES INC.

DWG #TAM 25685-17  
BCIN: 26064  
FIRM: 29991  
SEALED STRUCTURAL COMPONENTS ONLY

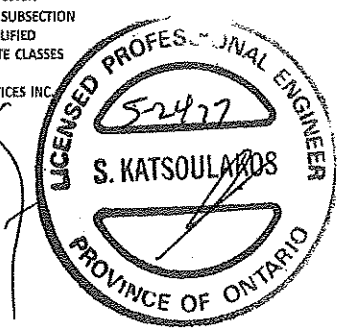

|                   |  |                            |  |                                                                                                                                                                                                                                                                                                                               |  |                     |  |            |  |                                     |  |
|-------------------|--|----------------------------|--|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--|---------------------|--|------------|--|-------------------------------------|--|
| Job Track: 44269  |  | Builder: GREENYORK HOMES / |  | Location: BRAMPTON                                                                                                                                                                                                                                                                                                            |  | Model: AUBURN 4 / 1 |  | Elevation: |  | C:\MITEK\CA742AJ\JOBS\ 813000000000 |  |
| Layout ID: 282361 |  | Project: OSTIENSE          |  | THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE. |  |                     |  |            |  |                                     |  |
| Plan Log: 92456   |  | Date: 5/19/2017            |  | Designer: JG                                                                                                                                                                                                                                                                                                                  |  | MiTek ver 7.5.0     |  |            |  |                                     |  |











## Delivery Shiplist

|           |          |
|-----------|----------|
| DATE      | 05/19/17 |
| SALES REP | Rick     |

|                           |                   |                    |
|---------------------------|-------------------|--------------------|
| JOB TRACK: 44269          | LAYOUT ID: 282361 | LOCATION: BRAMPTON |
| BUILDER: GREEN YORK HOMES | SUB-BUILDER:      |                    |
| MODEL: AUBURN 4           | ELEVATION: 1      |                    |

### ROOF TRUSSES

ROOF TRUSS SPACING: 24.0 IN. O.C. (TYP.)

| PROFILE                                                                            | QTY   | MARK TYPE         | PITCH TC BC | SPAN     | TRUSS HEIGHT | LUMBER |       | OVERHANG LEFT RIGHT  | HEEL HEIGHT LEFT RIGHT | LBS. BFT.        | BUNDLE # STACK # | LOAD BY: REMARKS |
|------------------------------------------------------------------------------------|-------|-------------------|-------------|----------|--------------|--------|-------|----------------------|------------------------|------------------|------------------|------------------|
|                                                                                    | PLY   |                   |             |          |              | TOP    | BOT   |                      |                        |                  |                  |                  |
|    | 1     | T1<br>HIP GIRDER  | 11.00       | 35-10-00 | 04-08-09     | 2 X 4  | 2 X 6 | 01-03-08<br>01-03-08 | 01-09-01<br>01-09-01   | 343.48           |                  |                  |
|                                                                                    | 2 Ply |                   | 0.00        |          |              |        |       |                      |                        | 208.66           |                  |                  |
|    | 1     | T1Z<br>HIP GIRDER | 11.00       | 35-10-00 | 04-08-09     | 2 X 4  | 2 X 6 | 01-03-08<br>01-03-08 | 01-09-01<br>01-09-01   | 343.48           |                  |                  |
|                                                                                    | 2 Ply |                   | 0.00        |          |              |        |       |                      |                        | 208.66           |                  |                  |
|    | 2     | T2<br>HIP         | 11.00       | 35-10-00 | 05-10-09     | 2 X 4  | 2 X 4 | 01-03-08<br>01-03-08 | 01-09-01<br>01-09-01   | 297.96<br>189.34 |                  |                  |
|    | 2     | T3<br>HIP         | 11.00       | 35-10-00 | 07-00-09     | 2 X 4  | 2 X 4 | 01-03-08<br>01-03-08 | 01-09-01<br>01-09-01   | 315.78<br>196.34 |                  |                  |
|    | 2     | T4<br>HIP         | 11.00       | 35-10-00 | 08-02-09     | 2 X 4  | 2 X 4 | 01-03-08<br>01-03-08 | 01-09-01<br>01-09-01   | 346.40<br>214.66 |                  |                  |
|    | 5     | T5<br>HIP         | 11.00       | 35-10-00 | 09-04-09     | 2 X 4  | 2 X 4 | 01-03-08<br>01-03-08 | 01-09-01<br>01-09-01   | 934.35<br>583.30 |                  |                  |
|   | 2     | T6<br>HIP         | 11.00       | 35-10-00 | 10-06-09     | 2 X 4  | 2 X 4 | 01-03-08<br>01-03-08 | 01-09-01<br>01-09-01   | 393.84<br>246.00 |                  |                  |
|  | 1     | T7<br>HIP GIRDER  | 14.00       | 10-10-00 | 05-02-02     | 2 X 4  | 2 X 4 | 00-07-00<br>00-00-00 | 00-03-08<br>01-01-11   | 51.14<br>33.34   |                  |                  |
|  | 1     | T8<br>ROOF        | 11.00       | 19-00-00 | 05-03-11     | 2 X 4  | 2 X 4 | 01-03-08<br>00-07-00 | 01-09-01<br>03-03-11   | 91.42<br>59.17   |                  |                  |
|  | 1     | T9<br>ROOF        | 11.00       | 19-00-00 | 07-01-11     | 2 X 4  | 2 X 4 | 01-03-08<br>00-07-00 | 01-09-01<br>03-03-11   | 93.74<br>59.67   |                  |                  |
|  | 2     | T10<br>ROOF       | 11.00       | 19-00-00 | 08-11-11     | 2 X 4  | 2 X 4 | 01-03-08<br>00-00-00 | 01-09-01<br>03-03-11   | 193.24<br>122.34 |                  |                  |
|  | 1     | T11<br>ROOF       | 11.00       | 19-00-00 | 10-09-11     | 2 X 4  | 2 X 4 | 01-03-08<br>00-00-00 | 01-09-01<br>03-03-11   | 120.34<br>76.17  |                  |                  |
|  | 1     | T13<br>COMMON     | 16.00       | 10-10-00 | 07-08-12     | 2 X 4  | 2 X 4 | 00-00-00<br>00-00-00 | 00-06-01<br>00-06-01   | 39.49<br>24.17   |                  |                  |
|  | 3     | T13S<br>SCISSOR   | 16.00       | 10-10-00 | 07-08-12     | 2 X 4  | 2 X 4 | 00-05-00<br>00-05-00 | 00-06-01<br>00-06-01   | 134.76<br>85.50  |                  |                  |
|  | 1     | T14<br>ROOF       | 0.00        | 03-10-08 | 02-02-00     | 2 X 4  | 2 X 4 | 00-00-00<br>00-00-00 | 02-02-00<br>02-02-00   | 30.84            |                  |                  |
|                                                                                    | 2 Ply |                   | 0.00        |          |              |        |       |                      |                        | 20.00            |                  |                  |
|  | 3     | PB1<br>PIGGYBACK  | 11.00       | 18-00-03 | 02-02-08     | 2 X 4  | 2 X 4 | 00-00-00<br>00-00-00 | 00-05-00<br>00-05-00   | 179.28<br>114.00 |                  |                  |
|  | 1     | PB2<br>PIGGYBACK  | 11.00       | 05-02-00 | 03-01-02     | 2 X 4  | 2 X 4 | 00-00-00<br>00-00-00 | 00-05-00<br>00-05-10   | 18.11<br>12.17   |                  |                  |
|  | 19    | J1<br>JACK-OPEN   | 7.00        | 05-10-08 | 04-08-09     | 2 X 4  | 2 X 4 | 01-03-08<br>00-00-00 | 01-03-07<br>04-08-09   | 328.70<br>202.73 |                  |                  |



## Delivery Shiplist

|           |          |
|-----------|----------|
| DATE      | 05/19/17 |
| SALES REP | Rick     |

|                           |                   |                    |
|---------------------------|-------------------|--------------------|
| JOB TRACK:44269           | LAYOUT ID: 282361 | LOCATION: BRAMPTON |
| BUILDER: GREEN YORK HOMES | SUB-BUILDER:      |                    |
| MODEL: AUBURN 4           | ELEVATION: 1      |                    |

### ROOF TRUSSES

ROOF TRUSS SPACING: 24.0 IN. O.C. (TYP.)

| PROFILE | QTY | MARK<br>TYPE    | PITCH<br>TC<br>BC | SPAN     | TRUSS<br>HEIGHT | LUMBER |       | OVERHANG<br>LEFT<br>RIGHT | HEEL HEIGHT<br>LEFT<br>RIGHT | LBS.<br>BFT.   | BUNDLE #<br>STACK # | LOAD BY:<br>REMARKS |
|---------|-----|-----------------|-------------------|----------|-----------------|--------|-------|---------------------------|------------------------------|----------------|---------------------|---------------------|
|         | PLY |                 |                   |          |                 | TOP    | BOT   |                           |                              |                |                     |                     |
|         | 3   | J2<br>JACK-OPEN | 11.00<br>0.00     | 03-10-08 | 05-03-11        | 2 X 4  | 2 X 4 | 01-03-08<br>00-00-00      | 01-09-01<br>05-03-11         | 52.05<br>33.99 |                     |                     |
|         | 1   | J3<br>JACK-OPEN | 11.00<br>0.00     | 03-10-08 | 03-04-11        | 2 X 4  | 2 X 4 | 01-03-08<br>-02-01-01     | 01-09-01<br>00-03-08         | 14.12<br>9.33  |                     |                     |
|         | 1   | J4<br>JACK-OPEN | 11.00<br>0.00     | 01-10-08 | 03-04-11        | 2 X 4  | 2 X 4 | 01-03-08<br>-00-01-01     | 01-09-01<br>00-03-08         | 10.41<br>7.50  |                     |                     |
|         | 4   | J5<br>JACK-OPEN | 14.00<br>0.00     | 03-05-08 | 05-02-02        | 2 X 4  | 2 X 4 | 00-07-00<br>00-00-00      | 00-03-08<br>05-02-02         | 53.96<br>34.68 |                     |                     |
|         | 2   | J6<br>JACK-OPEN | 14.00<br>0.00     | 03-05-08 | 03-02-11        | 2 X 4  | 2 X 4 | 00-07-00<br>-01-08-01     | 00-03-08<br>00-03-08         | 21.12<br>13.34 |                     |                     |
|         | 2   | J7<br>JACK-OPEN | 14.00<br>0.00     | 01-10-08 | 03-02-11        | 2 X 4  | 2 X 4 | 00-07-00<br>-00-01-01     | 00-03-08<br>00-03-08         | 17.50<br>12.00 |                     |                     |

TOTAL # TRUSS= 65.00

TOTAL BFT OF ALL TRUSSES=

2767.06 BFT. TOTAL WEIGHT OF ALL TRUSSES= 4425.51 LBS.

### HARDWARE

| QTY | ITEM TYPE | MODEL   | LENGTH<br>FT-IN-16 |
|-----|-----------|---------|--------------------|
| 2   | Hangers   | LJS26DS |                    |
| 6   | Hangers   | LUS24   |                    |
| 3   | Hangers   | LUS24-2 |                    |
| 1   | Hangers   | LUS26-2 |                    |

TOTAL # ITEMS= 12.00

## Schedule 1: Designer Information

Use one form for each individual who reviews and takes responsibility for design activities with respect to the project.


|                                                                                                                                                                                                                                                                                                                                                                                                       |                               |                                                                                                                                                                                           |                            |                                                                                                                                                                                                              |
|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>A. Project Information</b>                                                                                                                                                                                                                                                                                                                                                                         |                               |                                                                                                                                                                                           | <b>Application number:</b> |                                                                                                                                                                                                              |
| Building number, street name                                                                                                                                                                                                                                                                                                                                                                          |                               |                                                                                                                                                                                           | Unit no.                   | Lot/con.                                                                                                                                                                                                     |
| Municipality CITY OF BRAMPTON                                                                                                                                                                                                                                                                                                                                                                         | Postal code                   | Plan number/ other description                                                                                                                                                            |                            |                                                                                                                                                                                                              |
| <b>B. Individual who reviews and takes responsibility for design activities</b>                                                                                                                                                                                                                                                                                                                       |                               |                                                                                                                                                                                           |                            |                                                                                                                                                                                                              |
| Name<br><b>SAM KATSOULAKOS, P. ENG.</b>                                                                                                                                                                                                                                                                                                                                                               |                               | Firm<br><b>MICRO CITY ENGINEERING SERVICES INC.</b>                                                                                                                                       |                            |                                                                                                                                                                                                              |
| Street address<br><b>R.R #1, PO BOX 61</b>                                                                                                                                                                                                                                                                                                                                                            |                               |                                                                                                                                                                                           | Unit no.                   | Lot/con.                                                                                                                                                                                                     |
| Municipality<br><b>GLENCOE</b>                                                                                                                                                                                                                                                                                                                                                                        | Postal code<br><b>NOL 1M0</b> | Province<br><b>ONTARIO</b>                                                                                                                                                                | E-mail                     |                                                                                                                                                                                                              |
| Telephone number<br><b>(519) 287-2242 Business</b>                                                                                                                                                                                                                                                                                                                                                    |                               | Fax number<br><b>(519) 287-5750</b>                                                                                                                                                       | Cell number                |                                                                                                                                                                                                              |
| <b>C. Design activities undertaken by individual identified in Section B. [Building Code Table 3.5.2.1. of Division C]</b>                                                                                                                                                                                                                                                                            |                               |                                                                                                                                                                                           |                            |                                                                                                                                                                                                              |
| <input type="checkbox"/> House<br><input type="checkbox"/> Small Buildings<br><input type="checkbox"/> Large Buildings<br><input type="checkbox"/> Complex Buildings                                                                                                                                                                                                                                  |                               | <input type="checkbox"/> HVAC – House<br><input type="checkbox"/> Building Services<br><input type="checkbox"/> Detection, Lighting and Power<br><input type="checkbox"/> Fire Protection |                            | <input checked="" type="checkbox"/> Building Structural<br><input type="checkbox"/> Plumbing – House<br><input type="checkbox"/> Plumbing – All Buildings<br><input type="checkbox"/> On-site Sewage Systems |
| Description of designer's work <b>GREENYORK HOMES – OSTIENSE – MODEL: AUBURN 4 – ELEV. 1</b><br><b>(SCHEDULE IS NOT ISSUED AS LOT SPECIFIC)</b><br>REVIEW PRE-ENGINEERED ROOF SYSTEM COMPONENT DRAWINGS AND LAYOUT PLACEMENT PLAN SUPPLIED BY<br>TAMARACK ROOF TRUSSES INC. (SEE DWG #TAM25685-17 DATED 5-24-17).<br>SUPPORTING STRUCTURE TO BE REVIEWED AND VERIFIED BY QUALIFIED BUILDING DESIGNER. |                               |                                                                                                                                                                                           |                            |                                                                                                                                                                                                              |
| <b>D. Declaration of Designer</b>                                                                                                                                                                                                                                                                                                                                                                     |                               |                                                                                                                                                                                           |                            |                                                                                                                                                                                                              |
| I, <u>SAM KATSOULAKOS, P. ENG.</u> declare that (choose one as appropriate):<br><div style="text-align: center;">(print name)</div>                                                                                                                                                                                                                                                                   |                               |                                                                                                                                                                                           |                            |                                                                                                                                                                                                              |
| <input checked="" type="checkbox"/> I review and take responsibility for the design work on behalf of a firm registered under subsection 3.2.4. of Division C, of the Building Code. I am qualified, and the firm is registered, in the appropriate classes/categories.                                                                                                                               |                               |                                                                                                                                                                                           |                            |                                                                                                                                                                                                              |
| Individual BCIN: <u>26064</u><br>Firm BCIN: <u>29991</u>                                                                                                                                                                                                                                                                                                                                              |                               |                                                                                                                                                                                           |                            |                                                                                                                                                                                                              |
| <input type="checkbox"/> I review and take responsibility for the design and am qualified in the appropriate category as an "other designer" under subsection 3.2.5. of Division C, of the Building Code.                                                                                                                                                                                             |                               |                                                                                                                                                                                           |                            |                                                                                                                                                                                                              |
| Individual BCIN: _____<br>Basis for exemption from registration: _____                                                                                                                                                                                                                                                                                                                                |                               |                                                                                                                                                                                           |                            |                                                                                                                                                                                                              |
| <input type="checkbox"/> The design work is exempt from the registration and qualification requirements of the Building Code.                                                                                                                                                                                                                                                                         |                               |                                                                                                                                                                                           |                            |                                                                                                                                                                                                              |
| Basis for exemption from registration and qualification: _____                                                                                                                                                                                                                                                                                                                                        |                               |                                                                                                                                                                                           |                            |                                                                                                                                                                                                              |
| I certify that:                                                                                                                                                                                                                                                                                                                                                                                       |                               |                                                                                                                                                                                           |                            |                                                                                                                                                                                                              |
| 1. The information contained in this schedule is true to the best of my knowledge.                                                                                                                                                                                                                                                                                                                    |                               |                                                                                                                                                                                           |                            |                                                                                                                                                                                                              |
| 2. I have submitted this application with the knowledge and consent of the firm.                                                                                                                                                                                                                                                                                                                      |                               |                                                                                                                                                                                           |                            |                                                                                                                                                                                                              |
| Date                                                                                                                                                                                                                                                                                                                                                                                                  |                               | Signature of Designer                                                                                                                                                                     |                            |                                                                                                                                                                                                              |
| 5-24-17                                                                                                                                                                                                                                                                                                                                                                                               |                               |                                                                                                       |                            |                                                                                                                                                                                                              |

**NOTE:**

- For the purposes of this form, "individual" means the "person" referred to in Clause 3.2.4.7(1) d) of Division C, Article 3.2.5.1. of Division C, and all other persons who are exempt from qualification under Subsections 3.2.4. and 3.2.5. of Division C.
- Schedule 1 is not required to be completed by a holder of a license, temporary license, or a certificate of authorization, issued by the Ontario Association of Architects. Schedule 1 is also not required to be completed by a holder of a license to practise, a limited license to practise, or a certificate of authorization, issued by the Association of Professional Engineers of Ontario.

DWG # TAM 25685-17-S  
DWG # TAM 25686-17-S

5-24-17

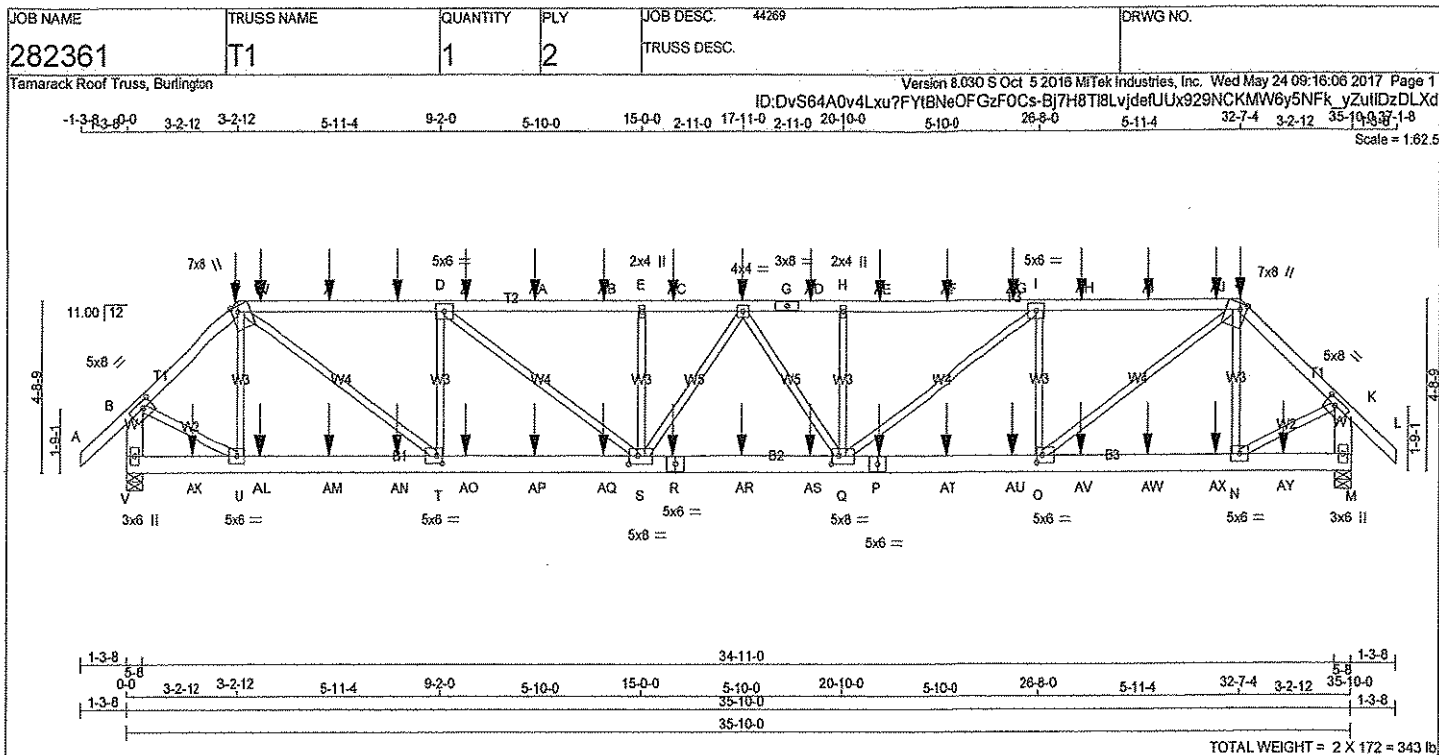

**LUMBER**

N. L. G. A. RULES

| CHORDS | SIZE | LUMBER         | DESCR. |
|--------|------|----------------|--------|
| A - C  | 2x4  | DRY No.2       | SPF    |
| C - G  | 2x4  | DRY No.2       | SPF    |
| G - J  | 2x4  | DRY No.2       | SPF    |
| J - L  | 2x4  | DRY No.2       | SPF    |
| V - B  | 2x6  | DRY No.2       | SPF    |
| M - K  | 2x6  | DRY No.2       | SPF    |
| V - R  | 2x6  | DRY 1650F 1.5E | SPF    |
| R - P  | 2x6  | DRY 1650F 1.5E | SPF    |
| P - M  | 2x6  | DRY 1650F 1.5E | SPF    |

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

| CHORDS #ROWS                             | SURFACE SPACING (IN) | LOAD (PLF) |
|------------------------------------------|----------------------|------------|
| TOP CHORDS : (0.122"x3") SPIRAL NAILS    |                      |            |
| A - C                                    | 12                   | SIDE(61.0) |
| C - G                                    | 12                   | SIDE(61.0) |
| G - J                                    | 12                   | SIDE(61.0) |
| J - L                                    | 12                   | SIDE(61.0) |
| V - B                                    | 12                   | TOP        |
| M - K                                    | 12                   | TOP        |
| BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS |                      |            |
| V - R                                    | 12                   | SIDE(0.0)  |
| R - P                                    | 12                   | SIDE(0.0)  |
| P - M                                    | 12                   | SIDE(0.0)  |
| WEBS : (0.122"x3") SPIRAL NAILS          |                      |            |
| 2x3                                      | 6                    |            |

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

**PLATES (table is in inches)**

| JT | TYPE   | PLATES | W   | LEN | Y    | X    |
|----|--------|--------|-----|-----|------|------|
| B  | TMVW-H | MT20   | 5.0 | 8.0 | 2.00 | 3.25 |
| C  | TTWW+m | MT20   | 7.0 | 8.0 | Edge | 2.25 |
| D  | TMVW-H | MT20   | 5.0 | 6.0 |      |      |
| E  | TMVW-H | MT20   | 2.0 | 4.0 |      |      |
| F  | TMVW-H | MT20   | 4.0 | 4.0 |      |      |
| G  | TS-I   | MT20   | 3.0 | 8.0 |      |      |
| H  | TMVW-H | MT20   | 2.0 | 4.0 |      |      |
| I  | TMVW-H | MT20   | 5.0 | 6.0 |      |      |
| J  | TTWW+m | MT20   | 7.0 | 8.0 | Edge | 2.25 |
| K  | TMVW-H | MT20   | 5.0 | 8.0 | 2.00 | 3.25 |
| M  | BMV1+p | MT20   | 3.0 | 6.0 |      |      |
| N  | BMVW-H | MT20   | 5.0 | 6.0 |      |      |
| O  | BMVW-H | MT20   | 5.0 | 6.0 | 2.50 | 2.00 |
| P  | BS-I   | MT20   | 5.0 | 6.0 |      |      |
| Q  | BMVW-H | MT20   | 5.0 | 8.0 | 2.75 | 2.50 |
| R  | BS-I   | MT20   | 5.0 | 6.0 |      |      |
| S  | BMVW-H | MT20   | 5.0 | 8.0 | 2.75 | 3.00 |

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

|    | FACTORED GROSS REACTION | MAXIMUM FACTORED GROSS REACTION | INPUT BRG | REQRD BRG |
|----|-------------------------|---------------------------------|-----------|-----------|
|    | VERT                    | HORZ                            | DOWN      | UP        |
| JT | 3413                    | 0                               | 3413      | 0         |
| V  | 3409                    | 0                               | 3409      | 0         |
| M  | 3409                    | 0                               | 3409      | 0         |

| UNFACTORED REACTIONS |           |                               |         |           |       |         |       |
|----------------------|-----------|-------------------------------|---------|-----------|-------|---------|-------|
|                      | 1ST LCASE | MAX./MIN. COMPONENT REACTIONS |         |           |       |         |       |
| JT                   | COMBINED  | SNOW                          | LIVE    | PERM.LIVE | WIND  | DEAD    | SOIL  |
| V                    | 2823      | 1534 / 0                      | 666 / 0 | 0 / 0     | 0 / 0 | 624 / 0 | 0 / 0 |
| M                    | 2820      | 1532 / 0                      | 665 / 0 | 0 / 0     | 0 / 0 | 623 / 0 | 0 / 0 |

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.17 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

**LOADING**

TOTAL LOAD CASES: (4)

| MAX. FACTORED |             | FACTORED         |               | WEBS                 |       | MAX. FACTORED |               |          |
|---------------|-------------|------------------|---------------|----------------------|-------|---------------|---------------|----------|
| MEMB.         | FORCE (LBS) | VERT. LOAD (PLF) | MAX. CSI (LC) | MAX. UNBRACED LENGTH | MEMB. | FORCE (LBS)   | MAX. CSI (LC) |          |
| FR-TO         |             | FROM             | TO            |                      | FR-TO |               |               |          |
| A-B           | 0 / 40      | -84.3            | -84.3         | 0.06 (1)             | 10.00 | U-C           | -656 / 0      | 0.10 (1) |
| B-C           | -3238 / 0   | -84.3            | -84.3         | 0.13 (1)             | 5.07  | C-T           | 0 / 3719      | 0.46 (1) |
| C-W           | -5370 / 0   | -84.3            | -84.3         | 0.63 (1)             | 3.61  | T-D           | -1923 / 0     | 0.31 (1) |
| W-X           | -5370 / 0   | -84.3            | -84.3         | 0.63 (1)             | 3.61  | D-S           | 0 / 1701      | 0.21 (1) |
| X-Y           | -5370 / 0   | -84.3            | -84.3         | 0.63 (1)             | 3.61  | S-E           | -803 / 0      | 0.10 (1) |
| Y-D           | -5370 / 0   | -84.3            | -84.3         | 0.63 (1)             | 3.61  | Q-H           | -604 / 0      | 0.10 (1) |
| D-Z           | -6735 / 0   | -84.3            | -84.3         | 0.74 (1)             | 3.17  | Q-I           | 0 / 1703      | 0.21 (1) |
| Z-AA          | -6735 / 0   | -84.3            | -84.3         | 0.74 (1)             | 3.17  | O-I           | -1924 / 0     | 0.31 (1) |
| AA-AB         | -6735 / 0   | -84.3            | -84.3         | 0.74 (1)             | 3.17  | O-J           | 0 / 3721      | 0.46 (1) |
| AB-E          | -6735 / 0   | -84.3            | -84.3         | 0.74 (1)             | 3.17  | N-J           | -855 / 0      | 0.10 (1) |
| E-AC          | -6735 / 0   | -84.3            | -84.3         | 0.35 (1)             | 3.50  | B-U           | 0 / 2559      | 0.32 (1) |
| AC-F          | -6735 / 0   | -84.3            | -84.3         | 0.35 (1)             | 3.50  | N-K           | 0 / 2556      | 0.32 (1) |
| F-G           | -6735 / 0   | -84.3            | -84.3         | 0.35 (1)             | 3.50  | S-F           | -161 / 0      | 0.04 (1) |
| G-AD          | -6735 / 0   | -84.3            | -84.3         | 0.35 (1)             | 3.50  | F-Q           | -160 / 0      | 0.04 (1) |
| AD-H          | -6735 / 0   | -84.3            | -84.3         | 0.35 (1)             | 3.50  |               |               |          |
| H-AE          | -6735 / 0   | -84.3            | -84.3         | 0.74 (1)             | 3.17  |               |               |          |
| AE-AF         | -6735 / 0   | -84.3            | -84.3         | 0.74 (1)             | 3.17  |               |               |          |
| AF-AG         | -6735 / 0   | -84.3            | -84.3         | 0.74 (1)             | 3.17  |               |               |          |
| AG-I          | -6735 / 0   | -84.3            | -84.3         | 0.74 (1)             | 3.17  |               |               |          |
| I-AH          | -5369 / 0   | -84.3            | -84.3         | 0.63 (1)             | 3.61  |               |               |          |
| AH-AJ         | -5369 / 0   | -84.3            | -84.3         | 0.63 (1)             | 3.61  |               |               |          |
| AJ-AJ         | -5369 / 0   | -84.3            | -84.3         | 0.63 (1)             | 3.61  |               |               |          |
| AJ-J          | -5369 / 0   | -84.3            | -84.3         | 0.63 (1)             | 3.61  |               |               |          |
| J-K           | -3234 / 0   | -84.3            | -84.3         | 0.13 (1)             | 5.07  |               |               |          |
| K-L           | 0 / 40      | -84.3            | -84.3         | 0.06 (1)             | 10.00 |               |               |          |
| V-B           | -3399 / 0   | 0.0              | 0.0           | 0.13 (1)             | 7.56  |               |               |          |
| M-K           | -3399 / 0   | 0.0              | 0.0           | 0.13 (1)             | 7.57  |               |               |          |
| V-AK          | 0 / 0       | -28.0            | -28.0         | 0.06 (2)             | 10.00 |               |               |          |
| AK-U          | 0 / 0       | -28.0            | -28.0         | 0.06 (2)             | 10.00 |               |               |          |
| U-AL          | 0 / 2361    | -28.0            | -28.0         | 0.14 (1)             | 10.00 |               |               |          |
| AL-AM         | 0 / 2361    | -28.0            | -28.0         | 0.14 (1)             | 10.00 |               |               |          |
| AM-AN         | 0 / 2361    | -28.0            | -28.0         | 0.14 (1)             | 10.00 |               |               |          |
| AN-T          | 0 / 2361    | -28.0            | -28.0         | 0.14 (1)             | 10.00 |               |               |          |
| T-AO          | 0 / 5370    | -28.0            | -28.0         | 0.27 (1)             | 10.00 |               |               |          |
| AO-AP         | 0 / 5370    | -28.0            | -28.0         | 0.27 (1)             | 10.00 |               |               |          |
| AP-AQ         | 0 / 5370    | -28.0            | -28.0         | 0.27 (1)             | 10.00 |               |               |          |
| AQ-S          | 0 / 5370    | -28.0            | -28.0         | 0.27 (1)             | 10.00 |               |               |          |
| S-R           | 0 / 6825    | -28.0            | -28.0         | 0.33 (1)             | 10.00 |               |               |          |
| R-AR          | 0 / 6825    | -28.0            | -28.0         | 0.33 (1)             | 10.00 |               |               |          |

LICENSED PROFESSIONAL ENGINEER

S. KATSOULAKOS

PROVINCE OF ONTARIO

DWG N

**DESIGN CRITERIA**

\*\*\* SPECIAL LOADS ANALYSIS \*\*\*  
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.  
LOADS WERE DERIVED FROM USER INPUT  
NO FURTHER MODIFICATIONS WERE MADE

**SPECIFIED LOADS:**

|                       |    |   |      |     |
|-----------------------|----|---|------|-----|
| TOP CH.               | LL | = | 25.6 | PSF |
|                       | DL | = | 3.0  | PSF |
| BOT CH.               | LL | = | 10.5 | PSF |
|                       | DL | = | 7.0  | PSF |
| TOTAL LOAD = 46.1 PSF |    |   |      |     |

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

\*\*\* NON STANDARD GIRDER \*\*\*  
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:  
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014  
- CSA 088-09  
- TPIC 2011

(55 OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.19")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.23")  
ALLOWABLE DEFL.(TL)= L/360 (1.19")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.37")

CSI: TC=0.74 (H-I:1), BC=0.33 (Q-S:1), WB=0.48 (J-O:1), SS=0.20 (L-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00  
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


**NAIL VALUES**

| PLATE | GRIP(DRY) | SHEAR (PSI) | SECTION (PLI) |
|-------|-----------|-------------|---------------|
| MT20  | 618       | 354         | 1667          |
|       | 822       | 2284        | 1656          |

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.69 (T) (INPUT = 0.90)  
JSI METAL= 0.55 (R) (INPUT = 1.00)

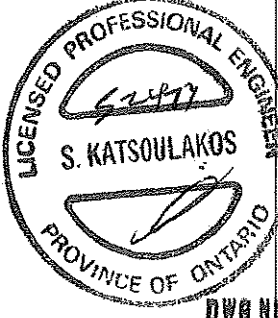

DWG NO. TAN25668-17

STRUCTURAL COMPONENT ONLY

CONTINUED ON PAGE 2

PLATES (table is in inches)
JT TYPE PLATES W LEN Y X
T BMWW-I MT20 5.0 6.0 2.50 2.00
U BMWW-I MT20 5.0 6.0
V BMV1+p MT20 3.0 6.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 164.4 lbs FACTORED DOWN AT 3-2-12, 164.4 lbs FACTORED DOWN AT 32-7-4, 115.4 lbs FACTORED DOWN AT 3-10-12, 101.4 lbs FACTORED DOWN AT 5-10-12, 101.4 lbs FACTORED DOWN AT 7-10-12, 101.4 lbs FACTORED DOWN AT 9-10-12, 101.4 lbs FACTORED DOWN AT 11-10-12, 101.4 lbs FACTORED DOWN AT 13-10-12, 101.4 lbs FACTORED DOWN AT 15-10-12, 101.4 lbs FACTORED DOWN AT 17-10-12, 101.4 lbs FACTORED DOWN AT 19-10-12, 101.4 lbs FACTORED DOWN AT 21-10-12, 101.4 lbs FACTORED DOWN AT 23-10-12, 101.4 lbs FACTORED DOWN AT 25-10-12, 101.4 lbs FACTORED DOWN AT 27-10-12, AND 101.4 lbs FACTORED DOWN AT 29-10-12, AND 113.6 lbs FACTORED DOWN AT 31-10-12 ON TOP CHORD, AND 70.9 lbs FACTORED DOWN AT 1-10-12, 70.9 lbs FACTORED DOWN AT 3-10-12, 70.9 lbs FACTORED DOWN AT 5-10-12, 70.9 lbs FACTORED DOWN AT 7-10-12, 70.9 lbs FACTORED DOWN AT 9-10-12, 70.9 lbs FACTORED DOWN AT 11-10-12, 70.9 lbs FACTORED DOWN AT 13-10-12, 70.9 lbs FACTORED DOWN AT 15-10-12, 70.9 lbs FACTORED DOWN AT 17-10-12, 70.9 lbs FACTORED DOWN AT 19-10-12, 70.9 lbs FACTORED DOWN AT 21-10-12, 70.9 lbs FACTORED DOWN AT 23-10-12, 70.9 lbs FACTORED DOWN AT 25-10-12, 70.9 lbs FACTORED DOWN AT 27-10-12, 70.9 lbs FACTORED DOWN AT 29-10-12, AND 70.9 lbs FACTORED DOWN AT 31-10-12, AND 70.9 lbs FACTORED DOWN AT 33-10-12 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

LOADING
TOTAL LOAD CASES: (4)
CHORDS
MEMB. MAX. FACTORED FORCE (LBS) FACTORED VERT. LOAD (PLF) LC1 MAX. CSI (LC) MAX. UNBRAC LENGTH FR-TO
FR-TO FROM TO
AR-AS -28.0 -28.0 0.33 (1) 10.00
AS-Q -28.0 -28.0 0.33 (1) 10.00
Q-P -28.0 -28.0 0.27 (1) 10.00
P-AT -28.0 -28.0 0.27 (1) 10.00
AT-AU -28.0 -28.0 0.27 (1) 10.00
AU-O -28.0 -28.0 0.27 (1) 10.00
O-AV -28.0 -28.0 0.14 (1) 10.00
AV-AW -28.0 -28.0 0.14 (1) 10.00
AW-AX -28.0 -28.0 0.14 (1) 10.00
AX-N -28.0 -28.0 0.14 (1) 10.00
N-AY 0/0 -28.0 -28.0 0.06 (2) 10.00
AY-M 0/0 -28.0 -28.0 0.06 (2) 10.00
WEBS
MEMB. MAX. FACTORED FORCE (LBS) MAX. FACTORED CSI (LC)
FACTORED CONCENTRATED LOADS (LBS)
JT LOC. LC1 MAX- MAX+ FACE DIR. TYPE
C 3-2-12 -164 -164 -- FRONT VERT TOTAL
F 17-10-12 -101 -101 -- BACK VERT TOTAL
J 32-7-4 -164 -164 -- FRONT VERT TOTAL
P 21-10-12 -41 -71 -- BACK VERT TOTAL
R 15-10-12 -41 -71 -- BACK VERT TOTAL
W 3-10-12 -115 -115 -- BACK VERT TOTAL
X 5-10-12 -101 -101 -- BACK VERT TOTAL
Y 7-10-12 -101 -101 -- BACK VERT TOTAL
Z 9-10-12 -101 -101 -- BACK VERT TOTAL
AA 11-10-12 -101 -101 -- BACK VERT TOTAL
AB 13-10-12 -101 -101 -- BACK VERT TOTAL
AC 15-10-12 -101 -101 -- BACK VERT TOTAL
AD 19-10-12 -101 -101 -- BACK VERT TOTAL
AE 21-10-12 -101 -101 -- BACK VERT TOTAL
AF 23-10-12 -101 -101 -- BACK VERT TOTAL
AG 25-10-12 -101 -101 -- BACK VERT TOTAL
AH 27-10-12 -101 -101 -- BACK VERT TOTAL
AI 29-10-12 -101 -101 -- BACK VERT TOTAL
AJ 31-10-12 -114 -114 -- BACK VERT TOTAL
AK 1-10-12 -41 -71 -- BACK VERT TOTAL
AL 3-10-12 -41 -71 -- BACK VERT TOTAL
AM 5-10-12 -41 -71 -- BACK VERT TOTAL
AN 7-10-12 -41 -71 -- BACK VERT TOTAL
AO 9-10-12 -41 -71 -- BACK VERT TOTAL
AP 11-10-12 -41 -71 -- BACK VERT TOTAL
AQ 13-10-12 -41 -71 -- BACK VERT TOTAL
AR 17-10-12 -41 -71 -- BACK VERT TOTAL
AS 19-10-12 -41 -71 -- BACK VERT TOTAL
AT 23-10-12 -41 -71 -- BACK VERT TOTAL
AU 25-10-12 -41 -71 -- BACK VERT TOTAL
AV 27-10-12 -41 -71 -- BACK VERT TOTAL
AW 29-10-12 -41 -71 -- BACK VERT TOTAL
AX 31-10-12 -41 -71 -- BACK VERT TOTAL
AY 33-10-12 -41 -71 -- BACK VERT TOTAL

DWG NO. YAM2566B-17
STRUCTURAL
COMPONENT ONLY



*per*

**DWG NO. YAM 2866B-17**  
**STRUCTURAL**  
**COMPONENT ONLY**


|          |            |          |     |             |       |          |
|----------|------------|----------|-----|-------------|-------|----------|
| JOB NAME | TRUSS NAME | QUANTITY | PLY | JOB DESC.   | 44269 | DRWG NO. |
| 282361   | T1Z        | 1        | 2   | TRUSS DESC. |       |          |

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 MiTek Industries, Inc. Wed May 24 09:16:07 2017 Page 1

ID: DvS64A0v4LxU?FYtBNe0FGzF0Cs-fvhlPmm5DrUGo3gUitZOVQIVKVD6g97ADeRlfzDLXc

1-3-8 3-2-12 3-2-12 5-11-4 9-2-0 5-10-0 15-0-0 2-11-0 17-11-0 2-11-0 20-10-0 5-10-0 26-8-0 5-11-4 32-7-4 3-2-12 35-10-0 1-3-8  
Scale = 1:62.5

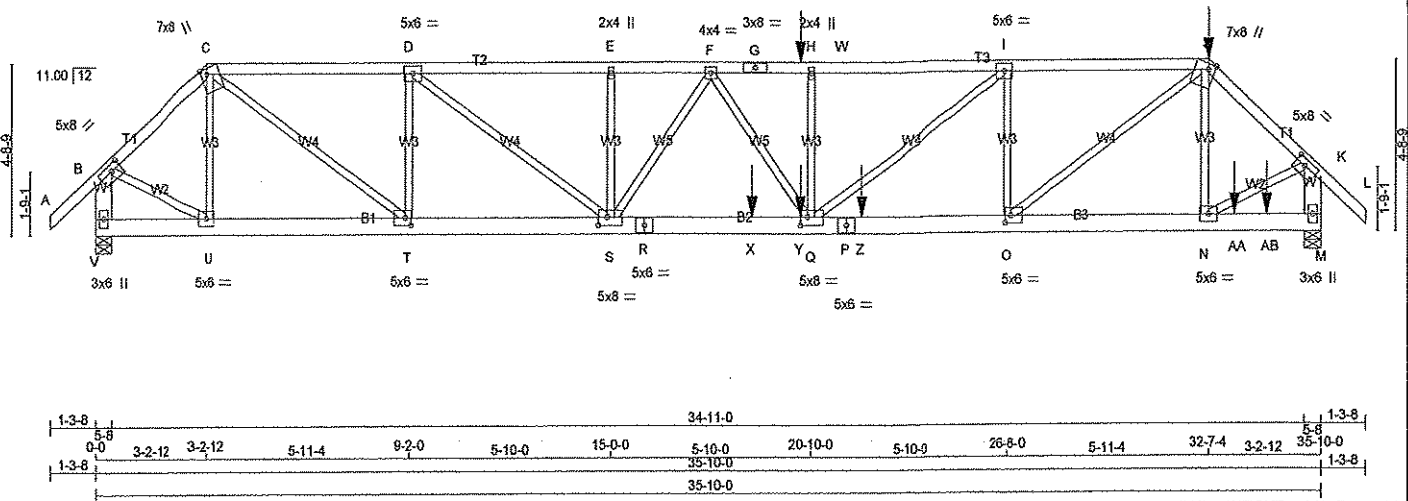

| LUMBER          | N. L. G. A. RULES | CHORDS     | SIZE | LUMBER | DESCR. |
|-----------------|-------------------|------------|------|--------|--------|
| A - C           | 2x4 DRY           | No.2       | SPF  |        |        |
| C - G           | 2x4 DRY           | No.2       | SPF  |        |        |
| G - J           | 2x4 DRY           | No.2       | SPF  |        |        |
| J - L           | 2x4 DRY           | No.2       | SPF  |        |        |
| V - B           | 2x6 DRY           | No.2       | SPF  |        |        |
| M - K           | 2x6 DRY           | No.2       | SPF  |        |        |
| V - R           | 2x6 DRY           | 1650F 1.5E | SPF  |        |        |
| R - P           | 2x6 DRY           | 1650F 1.5E | SPF  |        |        |
| P - M           | 2x6 DRY           | 1650F 1.5E | SPF  |        |        |
| ALL WEBS EXCEPT | 2x3 DRY           | No.2       | SPF  |        |        |

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

| CHORDS #ROWS                             | SURFACE SPACING (IN) | LOAD (PLF) |
|------------------------------------------|----------------------|------------|
| TOP CHORDS : (0.122"x3") SPIRAL NAILS    |                      |            |
| A - C 1 12                               | TOP                  |            |
| C - G 1 12                               | TOP                  |            |
| G - J 1 12                               | SIDE(61.0)           |            |
| J - L 1 12                               | SIDE(61.0)           |            |
| V - B 2 12                               | TOP                  |            |
| M - K 2 12                               | TOP                  |            |
| BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS |                      |            |
| V - R 2 12                               | TOP                  |            |
| R - P 2 12                               | SIDE(0.0)            |            |
| P - M 2 12                               | SIDE(0.0)            |            |
| WEBS : (0.122"x3") SPIRAL NAILS          |                      |            |
| 2x3 1 6                                  |                      |            |

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

| PLATES (table is in inches) | JT TYPE | PLATES | W   | LEN  | Y    | X |
|-----------------------------|---------|--------|-----|------|------|---|
| B TMVW-i                    | MT20    | 5.0    | 8.0 | 2.00 | 3.25 |   |
| C TTWW+m                    | MT20    | 7.0    | 8.0 | Edge | 2.25 |   |
| D TMVW-i                    | MT20    | 5.0    | 6.0 |      |      |   |
| E TMW+w                     | MT20    | 2.0    | 4.0 |      |      |   |
| F TMVW-i                    | MT20    | 4.0    | 4.0 |      |      |   |
| G TS-i                      | MT20    | 3.0    | 8.0 |      |      |   |
| H TMW+w                     | MT20    | 2.0    | 4.0 |      |      |   |
| I TMVW-i                    | MT20    | 5.0    | 6.0 |      |      |   |
| J TTWW+m                    | MT20    | 7.0    | 8.0 | Edge | 2.25 |   |
| K TMVW-i                    | MT20    | 5.0    | 8.0 | 2.00 | 3.25 |   |
| M BMV1+p                    | MT20    | 3.0    | 6.0 |      |      |   |
| N BMVW-i                    | MT20    | 5.0    | 6.0 |      |      |   |
| O BMVW-i                    | MT20    | 5.0    | 6.0 | 2.50 | 2.00 |   |
| P BS-i                      | MT20    | 5.0    | 6.0 |      |      |   |
| Q BMVWW-i                   | MT20    | 5.0    | 8.0 | 2.75 | 2.50 |   |
| R BS-i                      | MT20    | 5.0    | 6.0 |      |      |   |
| S BMVWW-i                   | MT20    | 5.0    | 8.0 | 2.75 | 3.00 |   |

#### DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

| BEARINGS                              |          |                |         | MAXIMUM FACTORED INPUT REQD |        |         |       |
|---------------------------------------|----------|----------------|---------|-----------------------------|--------|---------|-------|
| FACTORED GROSS REACTION               |          | GROSS REACTION |         | BRG                         |        | BRG     |       |
| JT                                    | VERT     | HORZ           | DOWN    | HORZ                        | UPLIFT | IN-SX   | IN-SX |
| V                                     | 3389     | 0              | 3389    | 0                           | 0      | 5-8     | 5-8   |
| M                                     | 4784     | 0              | 4784    | 0                           | 0      | 5-8     | 5-8   |
| UNFACTORED REACTIONS                  |          |                |         |                             |        |         |       |
| 1ST LCASE MAX/MIN COMPONENT REACTIONS |          |                |         |                             |        |         |       |
| JT                                    | COMBINED | SNOW           | LIVE    | PERMLIVE                    | WIND   | DEAD    | SOIL  |
| V                                     | 2735     | 1595 / 0       | 572 / 0 | 0 / 0                       | 0 / 0  | 588 / 0 | 0 / 0 |
| M                                     | 3866     | 2247 / 0       | 813 / 0 | 0 / 0                       | 0 / 0  | 805 / 0 | 0 / 0 |

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

#### BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.65 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

#### LOADING

TOTAL LOAD CASES: (4)

| CHORDS |                           |                           |                            | WEBS               |       |                           |                        |
|--------|---------------------------|---------------------------|----------------------------|--------------------|-------|---------------------------|------------------------|
| MEMB.  | MAX. FACTORED FORCE (LBS) | FACTORED VERT. LOAD (PLF) | LC1 MAX. FACTORED CSI (LC) | MAX. UNBRAC LENGTH | MEMB. | MAX. FACTORED FORCE (LBS) | MAX. FACTORED CSI (LC) |
| FR-TO  |                           | FROM TO                   |                            |                    | FR-TO |                           |                        |
| A-B    | 0 / 40                    | -84.3                     | -84.3 0.06 (1)             | 10.00              | U-C   | -722 / 0                  | 0.12 (1)               |
| B-C    | -3230 / 0                 | -84.3                     | -84.3 0.13 (1)             | 5.07               | C-T   | 0 / 4348                  | 0.54 (1)               |
| C-D    | -5872 / 0                 | -84.3                     | -84.3 0.48 (1)             | 3.68               | T-D   | -2502 / 0                 | 0.40 (1)               |
| D-E    | -8488 / 0                 | -84.3                     | -84.3 0.72 (1)             | 2.94               | D-S   | 0 / 3260                  | 0.40 (1)               |
| E-F    | -8488 / 0                 | -84.3                     | -84.3 0.36 (1)             | 3.16               | S-E   | -361 / 0                  | 0.06 (1)               |
| F-G    | -9722 / 0                 | -84.3                     | -84.3 0.44 (1)             | 2.89               | Q-H   | -444 / 0                  | 0.07 (1)               |
| G-W    | -9722 / 0                 | -84.3                     | -84.3 0.44 (1)             | 2.89               | Q-I   | 0 / 3375                  | 0.42 (1)               |
| W-H    | -9722 / 0                 | -84.3                     | -84.3 0.44 (1)             | 2.89               | O-I   | -2567 / 0                 | 0.41 (1)               |
| H-I    | -9722 / 0                 | -84.3                     | -84.3 0.86 (1)             | 2.65               | O-J   | 0 / 4665                  | 0.58 (1)               |
| I-J    | -7014 / 0                 | -84.3                     | -84.3 0.58 (1)             | 3.33               | N-J   | -269 / 42                 | 0.04 (1)               |
| J-K    | -4421 / 0                 | -84.3                     | -84.3 0.16 (1)             | 4.44               | B-U   | 0 / 2553                  | 0.32 (1)               |
| K-L    | 0 / 40                    | -84.3                     | -84.3 0.06 (1)             | 10.00              | N-K   | 0 / 3494                  | 0.43 (1)               |
| V-B    | -3392 / 0                 | 0.0                       | 0.0 0.13 (1)               | 7.57               | S-F   | -1231 / 0                 | 0.28 (1)               |
| M-K    | -4549 / 0                 | 0.0                       | 0.0 0.17 (1)               | 6.76               | F-Q   | 0 / 980                   | 0.12 (1)               |
| V-U    | 0 / 0                     | -28.0                     | -28.0 0.04 (2)             | 10.00              |       |                           |                        |
| U-T    | 0 / 2354                  | -28.0                     | -28.0 0.14 (1)             | 10.00              |       |                           |                        |
| T-S    | 0 / 5872                  | -28.0                     | -28.0 0.31 (1)             | 10.00              |       |                           |                        |
| S-R    | 0 / 9175                  | -28.0                     | -28.0 0.68 (1)             | 10.00              |       |                           |                        |
| R-X    | 0 / 9175                  | -28.0                     | -28.0 0.68 (1)             | 10.00              |       |                           |                        |
| X-Y    | 0 / 9175                  | -28.0                     | -28.0 0.68 (1)             | 10.00              |       |                           |                        |
| Y-Q    | 0 / 9175                  | -28.0                     | -28.0 0.68 (1)             | 10.00              |       |                           |                        |
| Q-P    | 0 / 7014                  | -28.0                     | -28.0 0.55 (1)             | 10.00              |       |                           |                        |
| P-Z    | 0 / 7014                  | -28.0                     | -28.0 0.55 (1)             | 10.00              |       |                           |                        |
| Z-O    | 0 / 7014                  | -28.0                     | -28.0 0.55 (1)             | 10.00              |       |                           |                        |
| O-N    | 0 / 3240                  | -28.0                     | -28.0 0.21 (1)             | 10.00              |       |                           |                        |
| N-AA   | 0 / 0                     | -28.0                     | -28.0 0.12 (1)             | 10.00              |       |                           |                        |
| AA-AB  | 0 / 0                     | -28.0                     | -28.0 0.12 (1)             | 10.00              |       |                           |                        |
| AB-M   | 0 / 0                     | -28.0                     | -28.0 0.12 (1)             | 10.00              |       |                           |                        |

LICENSED PROFESSIONAL

52417

S. KATSOUKAKIS

PROFESSIONAL

#### FACTORED CONCENTRATED LOADS (LBS)

| JT | LOC.    | LC1   | MAX.  | FACE  | DIR. | TOTAL |
|----|---------|-------|-------|-------|------|-------|
| JT | 32-7-4  | -164  | -164  | FRONT | VERT | TOTAL |
| W  | 20-6-4  | -101  | -101  | FRONT | VERT | TOTAL |
| X  | 19-1-8  | -1590 | -1590 | FRONT | VERT | TOTAL |
| Y  | 20-6-4  | -41   | -71   | FRONT | VERT | TOTAL |
| Z  | 22-3-8  | -990  | -990  | FRONT | VERT | TOTAL |
| AA | 33-4-8  | -990  | -990  | FRONT | VERT | TOTAL |
| AB | 34-3-12 | -41   | -71   | FRONT | VERT | TOTAL |

#### DESIGN CRITERIA

\*\*\* SPECIAL LOADS ANALYSIS \*\*\*  
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.  
LOADS WERE DERIVED FROM USER INPUT  
NO FURTHER MODIFICATIONS WERE MADE

#### SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF  
DL = 3.0 PSF  
BOT CH. LL = 10.5 PSF  
DL = 7.0 PSF  
TOTAL LOAD = 48.1 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

\*\*\* NON STANDARD GIRDER \*\*\*  
ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:  
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014  
- CSA 086-09  
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.19")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.34")  
ALLOWABLE DEFL.(TL)= L/360 (1.19")  
CALCULATED VERT. DEFL.(TL) = L/793 (0.54")

CSI: TC=0.86 (H-I:1), BC=0.68 (Q-S:1), WB=0.68 (J-O:1), SSI=0.46 (Q-S:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00  
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

| NAIL VALUES | PLATE GRIP(DRY) | SHEAR (PSI) | SECTION (PLI) |
|-------------|-----------------|-------------|---------------|
| MT20        | 618             | 354         | 1667          |
|             | 822             | 2284        | 1656          |

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.89 (U) (INPUT = 0.80)  
JSI METAL= 0.79 (R) (INPUT = 1.00)

DWG NO. TAM 25669-17

STRUCTURAL  
COMPONENT ONLY

CONTINUED ON PAGE 2

|                                 |                          |                      |                 |                                |          |
|---------------------------------|--------------------------|----------------------|-----------------|--------------------------------|----------|
| JOB NAME<br><b>282361</b>       | TRUSS NAME<br><b>T1Z</b> | QUANTITY<br><b>1</b> | PLY<br><b>2</b> | JOB DESC. 44269<br>TRUSS DESC. | DRWG NO. |
| Tamarack Roof Truss, Burlington |                          |                      |                 |                                |          |

Version 8.030 S Oct 5 2016 MitTek Industries, Inc. Wed May 24 09:16:07 2017 Page 2

ID:DvS64A0v4Lxu?FYtBNe0FGzF0Cs-fvhlLpmm5DrUGo3gUIZ0vQtVKVDr6g97ADeRlfzDLXc


**PLATES (table is in inches)**

| JT | TYPE   | PLATES | W   | LEN | Y    | X    |
|----|--------|--------|-----|-----|------|------|
| T  | BMWW-t | MT20   | 5.0 | 6.0 | 2.50 | 2.00 |
| U  | BMWW-t | MT20   | 5.0 | 6.0 |      |      |
| V  | BMV1+p | MT20   | 3.0 | 6.0 |      |      |

Edge - INDICATES REFERENCE CORNER OF PLATE  
TOUCHES EDGE OF CHORD.

**HANGERS NOTES**

- 1) SPECIAL HANGER(S) OR CONNECTION(S)  
REQUIRED TO SUPPORT CONCENTRATED  
LOAD(S) 164.4 lbs FACTORED DOWN AT 32-7-4,  
AND 101.4 lbs FACTORED DOWN AT 20-6-4 ON  
TOP CHORD, AND 1589.6 lbs FACTORED DOWN  
AT 19-1-8, 70.9 lbs FACTORED DOWN AT  
20-6-4, 989.9 lbs FACTORED DOWN AT 22-3-8,  
AND 989.9 lbs FACTORED DOWN AT 33-4-8,  
AND 70.9 lbs FACTORED DOWN AT 34-3-12 ON  
BOTTOM CHORD. DESIGN FOR UNSPECIFIED  
CONNECTION(S) IS DELEGATED TO THE  
BUILDING DESIGNER.

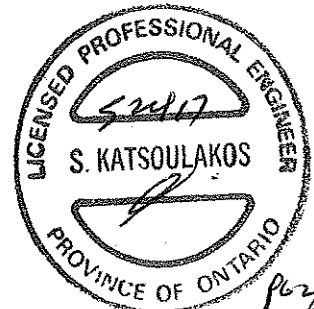

DWG NO. YAW 25669-17  
STRUCTURAL  
COMPONENT ONLY



STRUCTURAL  
COMPONENT ONLY


|          |            |          |     |             |       |          |
|----------|------------|----------|-----|-------------|-------|----------|
| JOB NAME | TRUSS NAME | QUANTITY | PLY | JOB DESC.   | 44269 | DRWG NO. |
| 282361   | T3         | 2        | 1   | TRUSS DESC. |       |          |

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 MitTek Industries, Inc. Wed May 24 09:16:07 2017 Page 1

ID:DvS64A0v4LXu?FYIBNaOFGzF0Cs-fvhlLpmm5DrUGo3gUIZOVQXJVGq6eG7ADeRlfzDLXc

Scale = 1:62.7

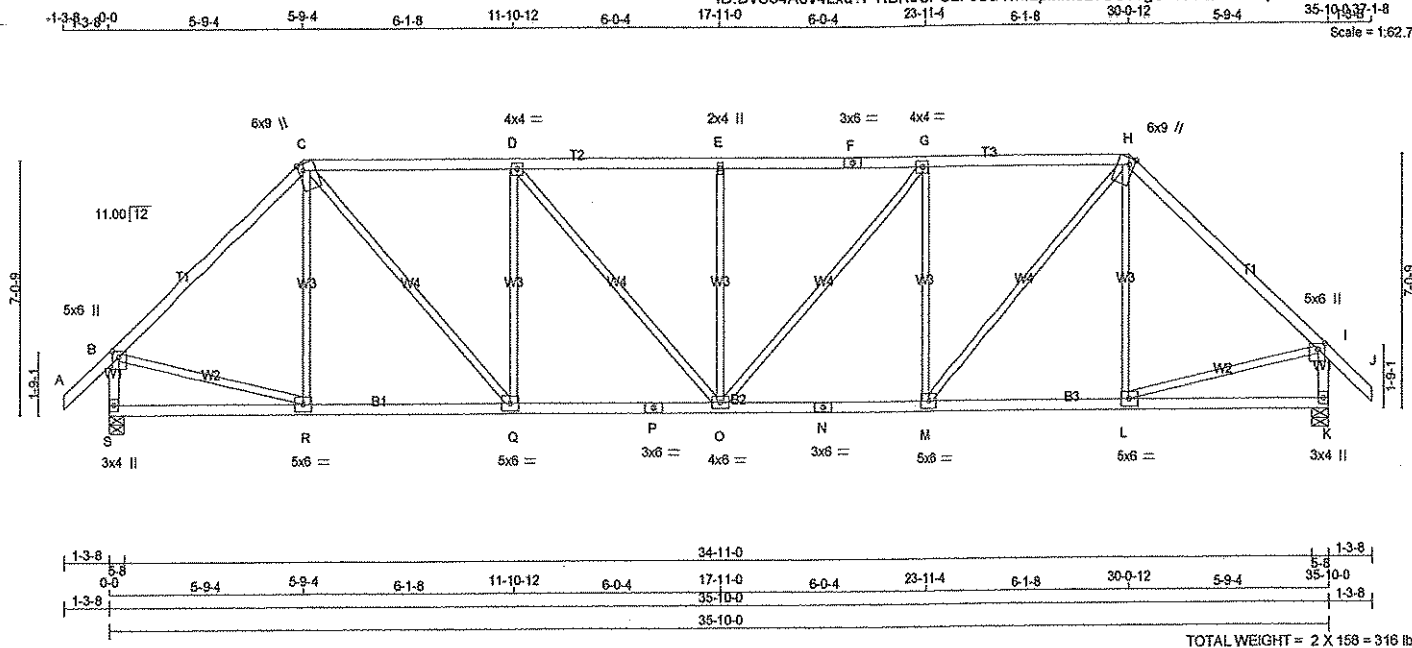

TOTAL WEIGHT = 2 X 158 = 316 lb

#### LUMBER

N. L. G. A. RULES

| CHORDS | SIZE | LUMBER | DESCR. |
|--------|------|--------|--------|
| A - C  | 2x4  | DRY    | No.2   |
| C - F  | 2x4  | DRY    | No.2   |
| F - H  | 2x4  | DRY    | No.2   |
| H - J  | 2x4  | DRY    | No.2   |
| S - B  | 2x4  | DRY    | No.2   |
| K - I  | 2x4  | DRY    | No.2   |
| S - P  | 2x4  | DRY    | No.2   |
| P - N  | 2x4  | DRY    | No.2   |
| N - K  | 2x4  | DRY    | No.2   |

ALL WEBS 2x3 DRY No.2 SPF  
EXCEPT

DRY: SEASONED LUMBER.

#### PLATES (table is in inches)

| JT         | TYPE   | PLATES | W   | LEN | Y    | X    |
|------------|--------|--------|-----|-----|------|------|
| B          | TMVW+p | MT20   | 5.0 | 6.0 | 2.00 | 2.25 |
| C          | TTWW+m | MT20   | 6.0 | 9.0 | Edge | 1.75 |
| D          | TMWW-t | MT20   | 4.0 | 4.0 |      |      |
| E          | TMW+w  | MT20   | 2.0 | 4.0 |      |      |
| F          | TS-t   | MT20   | 3.0 | 6.0 |      |      |
| G          | TMWW-t | MT20   | 4.0 | 4.0 |      |      |
| H          | TTWW+m | MT20   | 6.0 | 9.0 | Edge | 1.75 |
| I          | TMVW+p | MT20   | 5.0 | 6.0 | 2.00 | 2.25 |
| K          | BMV1+p | MT20   | 3.0 | 4.0 |      |      |
| L, M, Q, R |        |        |     |     |      |      |
| L          | BMWW-t | MT20   | 5.0 | 6.0 |      |      |
| N          | BS-t   | MT20   | 3.0 | 6.0 |      |      |
| O          | BMWW-t | MT20   | 4.0 | 6.0 |      |      |
| P          | BS-t   | MT20   | 3.0 | 6.0 |      |      |
| S          | BMV1+p | MT20   | 3.0 | 4.0 |      |      |

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

#### DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

##### BEARINGS

|    | FACTORED       | MAXIMUM FACTORED | INPUT | REQD   |
|----|----------------|------------------|-------|--------|
|    | GROSS REACTION | GROSS REACTION   | BRG   | BRG    |
| JT | VERT           | HORZ             | DOWN  | UPLIFT |
| S  | 2128           | 0                | 2128  | 0      |
| K  | 2128           | 0                | 2128  | 0      |

##### UNFACTORED REACTIONS

|    | 1ST LCASE | SNOW    | LIVE    | PERM.LIVE | WIND  | DEAD    | SOIL  |
|----|-----------|---------|---------|-----------|-------|---------|-------|
| JT | COMBINED  |         |         |           |       |         |       |
| S  | 1731      | 988 / 0 | 376 / 0 | 0 / 0     | 0 / 0 | 367 / 0 | 0 / 0 |
| K  | 1731      | 988 / 0 | 376 / 0 | 0 / 0     | 0 / 0 | 367 / 0 | 0 / 0 |

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

##### BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.55 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

##### LOADING

TOTAL LOAD CASES: (4)

| CHORDS |                           |                           |                                   | WEBS  |                           |                                   |                                   |
|--------|---------------------------|---------------------------|-----------------------------------|-------|---------------------------|-----------------------------------|-----------------------------------|
| MEMB.  | MAX. FACTORED FORCE (LBS) | FACTORED VERT. LOAD (PLF) | MAX. FACTORED VERT. LOAD (LC) (1) | MEMB. | MAX. FACTORED FORCE (LBS) | MAX. FACTORED VERT. LOAD (LC) (1) | MAX. FACTORED VERT. LOAD (LC) (1) |
| FR-TO  |                           | FROM                      | TO                                | FR-TO |                           | FROM                              | TO                                |
| A-B    | 0 / 40                    | -84.3                     | -84.3 0.12 (1)                    | 10.00 | R-C                       | -164 / 148                        | 0.14 (1)                          |
| B-C    | -1994 / 0                 | -84.3                     | -84.3 0.74 (1)                    | 4.06  | C-Q                       | 0 / 1428                          | 0.32 (1)                          |
| C-D    | -2425 / 0                 | -84.3                     | -84.3 0.65 (1)                    | 3.76  | Q-D                       | -892 / 0                          | 0.76 (1)                          |
| D-E    | -2708 / 0                 | -84.3                     | -84.3 0.68 (1)                    | 3.55  | D-O                       | 0 / 426                           | 0.10 (1)                          |
| E-F    | -2708 / 0                 | -84.3                     | -84.3 0.68 (1)                    | 3.55  | O-E                       | -467 / 0                          | 0.40 (1)                          |
| F-G    | -2708 / 0                 | -84.3                     | -84.3 0.68 (1)                    | 3.55  | O-G                       | 0 / 426                           | 0.10 (1)                          |
| G-H    | -2425 / 0                 | -84.3                     | -84.3 0.65 (1)                    | 3.76  | M-G                       | -892 / 0                          | 0.76 (1)                          |
| H-I    | -1994 / 0                 | -84.3                     | -84.3 0.74 (1)                    | 4.06  | M-H                       | 0 / 1428                          | 0.32 (1)                          |
| I-J    | 0 / 40                    | -84.3                     | -84.3 0.12 (1)                    | 10.00 | L-H                       | -164 / 148                        | 0.14 (1)                          |
| S-B    | -2063 / 0                 | 0.0                       | 0.0 0.22 (1)                      | 5.89  | B-R                       | 0 / 1508                          | 0.34 (1)                          |
| K-I    | -2063 / 0                 | 0.0                       | 0.0 0.22 (1)                      | 5.89  | L-I                       | 0 / 1508                          | 0.34 (1)                          |
| S-R    | 0 / 0                     | -28.0                     | -28.0 0.24 (3)                    | 10.00 |                           |                                   |                                   |
| R-Q    | 0 / 1464                  | -28.0                     | -28.0 0.42 (2)                    | 10.00 |                           |                                   |                                   |
| Q-P    | 0 / 2425                  | -28.0                     | -28.0 0.49 (1)                    | 10.00 |                           |                                   |                                   |
| P-O    | 0 / 2425                  | -28.0                     | -28.0 0.49 (1)                    | 10.00 |                           |                                   |                                   |
| O-N    | 0 / 2425                  | -28.0                     | -28.0 0.49 (1)                    | 10.00 |                           |                                   |                                   |
| N-M    | 0 / 2425                  | -28.0                     | -28.0 0.49 (1)                    | 10.00 |                           |                                   |                                   |
| M-L    | 0 / 1464                  | -28.0                     | -28.0 0.42 (2)                    | 10.00 |                           |                                   |                                   |
| L-K    | 0 / 0                     | -28.0                     | -28.0 0.24 (3)                    | 10.00 |                           |                                   |                                   |

#### DESIGN CRITERIA

##### SPECIFIED LOADS:

|                   |           |     |
|-------------------|-----------|-----|
| TOP CH.           | LL = 25.6 | PSF |
| DL = 3.0          | PSF       |     |
| BOT CH.           | LL = 10.5 | PSF |
| DL = 7.0          | PSF       |     |
| TOTAL LOAD = 46.1 | PSF       |     |

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:  
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014  
- CSA 088-09  
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) =  $L/360$  (1.19")  
CALCULATED VERT. DEFL.(LL) =  $L/999$  (0.16")  
ALLOWABLE DEFL.(TL) =  $L/360$  (1.19")  
CALCULATED VERT. DEFL.(TL) =  $L/999$  (0.27")

CSI: TC=0.74 (H-I:1), BC=0.49 (O-Q:1), WB=0.76 (D-Q:1), SSI=0.24 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10  
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


##### NAIL VALUES

| PLATE   | GRIP(DRY) | SHEAR    | SECTION   |
|---------|-----------|----------|-----------|
| (PSI)   | (PLI)     | (PLI)    | (PLI)     |
| MAX MIN | MAX MIN   | MAX MIN  | MAX MIN   |
| MT20    | 618 354   | 1667 822 | 2284 1655 |

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (B) (INPUT = 0.90)  
JSI METAL= 0.72 (N) (INPUT = 1.00)

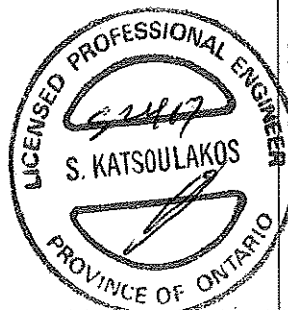


DWG NO. YAM25671-17  
STRUCTURAL  
COMPONENT ONLY

|          |            |          |     |             |       |          |
|----------|------------|----------|-----|-------------|-------|----------|
| JOB NAME | TRUSS NAME | QUANTITY | PLY | JOB DESC.   | 44269 | DRWG NO. |
| 282361   | T4         | 2        | 1   | TRUSS DESC. |       |          |

Tamarack Roof Truss, Burlington


Version 8.030 5 Oct 5 2016 MiTek Industries, Inc. Wed May 24 09:16:08 2017 Page 1  
ID:DvS64A0v4Lxu7FYIBNeOFGzF0Cs-75F1Y9nOsXzLuyes2a4dSdPfavbOr3rGPIN\_q5zDLXb  
Scale = 1:62.5

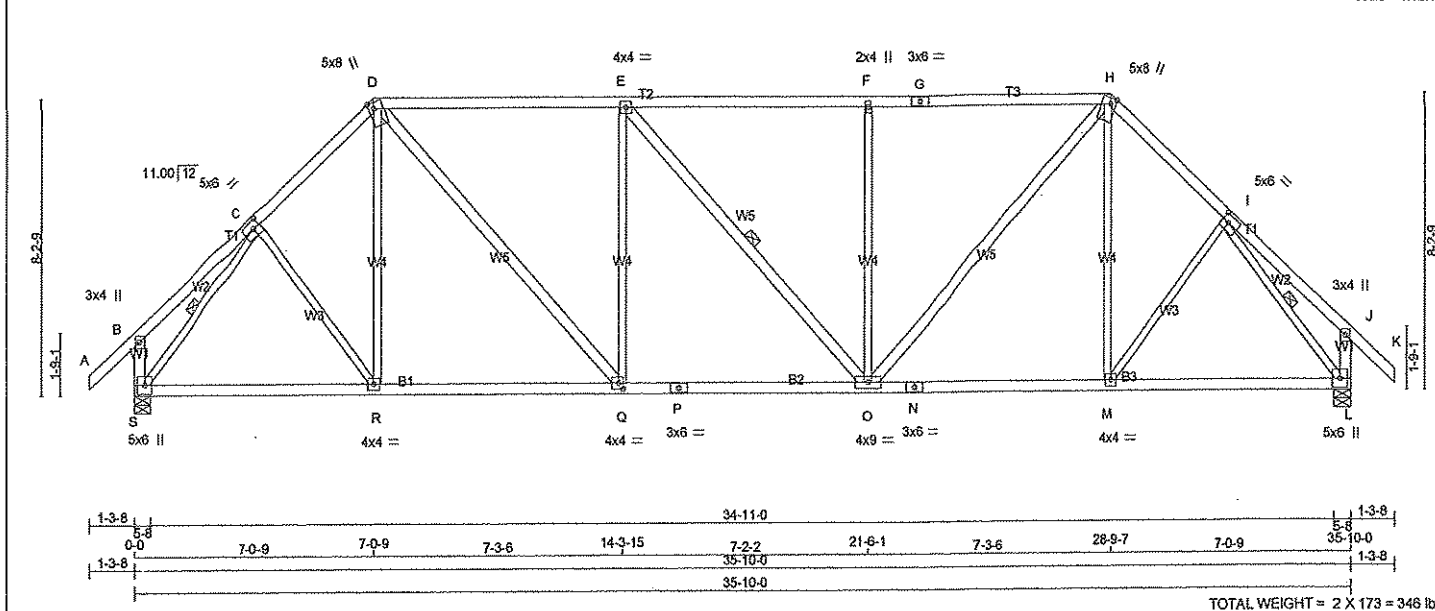


|                          |      |        |        |                                                                                                      |                              |         |           |                                                                                                   |                   |       |  |
|--------------------------|------|--------|--------|------------------------------------------------------------------------------------------------------|------------------------------|---------|-----------|---------------------------------------------------------------------------------------------------|-------------------|-------|--|
| <b>LUMBER</b>            |      |        |        | <b>DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER</b> |                              |         |           | <b>DESIGN CRITERIA</b>                                                                            |                   |       |  |
| <b>N. L. G. A. RULES</b> |      |        |        | <b>BEARINGS</b>                                                                                      |                              |         |           | <b>SPECIFIED LOADS:</b>                                                                           |                   |       |  |
| CHORDS                   | SIZE | LUMBER | DESCR. | FACTORED                                                                                             | MAXIMUM FACTORED             | INPUT   | REQRD     | TOP CH.                                                                                           | LL = 25.6         | PSF   |  |
| A - D                    | 2x4  | DRY    | No.2   | GROSS REACTION                                                                                       | GROSS REACTION               | BRG     | BRG       | DL = 3.0                                                                                          | PSF               |       |  |
| D - G                    | 2x4  | DRY    | No.2   | JT VERT                                                                                              | DOWN                         | HORZ    | UPLIFT    | BOT CH.                                                                                           | LL = 10.5         | PSF   |  |
| G - H                    | 2x4  | DRY    | No.2   | S                                                                                                    | 2128                         | 0       | 2128      | 0                                                                                                 | DL = 7.0          | PSF   |  |
| H - K                    | 2x4  | DRY    | No.2   | L                                                                                                    | 2128                         | 0       | 2128      | 0                                                                                                 | TOTAL LOAD = 46.1 | PSF   |  |
| S - B                    | 2x4  | DRY    | No.2   | <b>UNFACTORED REACTIONS</b>                                                                          |                              |         |           | <b>SPACING = 24.0 IN/C</b>                                                                        |                   |       |  |
| L - J                    | 2x4  | DRY    | No.2   | 1ST LCASE                                                                                            | MAX MIN. COMPONENT REACTIONS |         |           | <b>LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12</b>                                        |                   |       |  |
| S - P                    | 2x4  | DRY    | No.2   | JT COMBINED                                                                                          | SNOW                         | LIVE    | PERM.LIVE | WIND                                                                                              | DEAD              | SOIL  |  |
| P - N                    | 2x4  | DRY    | No.2   | S                                                                                                    | 1731                         | 988 / 0 | 376 / 0   | 0 / 0                                                                                             | 367 / 0           | 0 / 0 |  |
| N - L                    | 2x4  | DRY    | No.2   | L                                                                                                    | 1731                         | 988 / 0 | 376 / 0   | 0 / 0                                                                                             | 367 / 0           | 0 / 0 |  |
| ALL WEBS EXCEPT          | 2x3  | DRY    | No.2   | <b>BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L</b>                                    |                              |         |           | <b>THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010</b> |                   |       |  |
| D - Q                    | 2x4  | DRY    | No.2   | <b>BRACING</b>                                                                                       |                              |         |           | <b>THIS DESIGN COMPLIES WITH:</b>                                                                 |                   |       |  |
| E - O                    | 2x4  | DRY    | No.2   | TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.56 FT.                                           |                              |         |           | - PART 9 OF OBC 2012, BCBC 2012, ABC 2014                                                         |                   |       |  |
| O - H                    | 2x4  | DRY    | No.2   | MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.                     |                              |         |           | - CSA 086-09                                                                                      |                   |       |  |

DRY: SEASONED LUMBER.

|                                    |        |     |         |                                                                                                                           |  |  |  |                                                                                                           |  |  |  |
|------------------------------------|--------|-----|---------|---------------------------------------------------------------------------------------------------------------------------|--|--|--|-----------------------------------------------------------------------------------------------------------|--|--|--|
| <b>PLATES (table is in inches)</b> |        |     |         | <b>ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.</b>                                         |  |  |  | <b>(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD)</b> |  |  |  |
| JT TYPE                            | PLATES | W   | LEN Y X | <b>1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-O, C-S, I-L.</b>                                                                 |  |  |  | <b>ALLOWABLE DEFL.(LL)= L/360 (1.19')</b>                                                                 |  |  |  |
| B TMV+p                            | MT20   | 3.0 | 4.0     | <b>END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW</b> |  |  |  | <b>CALCULATED VERT. DEFL.(LL) = L/999 (0.14')</b>                                                         |  |  |  |
| C TMWW-t                           | MT20   | 5.0 | 6.0     | <b>LOADING</b>                                                                                                            |  |  |  | <b>ALLOWABLE DEFL.(TL)= L/360 (1.19')</b>                                                                 |  |  |  |
| D TTWW+m                           | MT20   | 5.0 | 8.0     | <b>TOTAL LOAD CASES: (4)</b>                                                                                              |  |  |  | <b>CALCULATED VERT. DEFL.(TL) = L/999 (0.24')</b>                                                         |  |  |  |
| E TMWW-t                           | MT20   | 4.0 | 4.0     | <b>CHORDS</b>                                                                                                             |  |  |  | <b>CSI: TC=0.90 (D-E:1), BC=0.53 (O-Q:2), WB=0.87 (E-Q:1), CSI=0.29 (D-E:1)</b>                           |  |  |  |
| F TMW+w                            | MT20   | 2.0 | 4.0     | <b>MEMB. MAX. FACTORED FORCE (LBS)</b>                                                                                    |  |  |  | <b>DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10</b>                                                             |  |  |  |
| G TS-t                             | MT20   | 3.0 | 6.0     | <b>VERT. LOAD LC1 MAX (PLF)</b>                                                                                           |  |  |  | <b>COMP=1.10 SHEAR=1.10 TENS= 1.10</b>                                                                    |  |  |  |
| H TTWW+m                           | MT20   | 5.0 | 8.0     | <b>CS1 (LC) UNBRAC LENGTH</b>                                                                                             |  |  |  | <b>COMPANION LIVE LOAD FACTOR = 0.50</b>                                                                  |  |  |  |
| I TMWW-t                           | MT20   | 5.0 | 6.0     | <b>FR-TO</b>                                                                                                              |  |  |  | <b>TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.</b>  |  |  |  |
| J TMV+p                            | MT20   | 3.0 | 4.0     | <b>MEMB. MAX. FACTORED FORCE (LBS)</b>                                                                                    |  |  |  | <b>NAIL VALUES</b>                                                                                        |  |  |  |
| L BMVW1+p                          | MT20   | 5.0 | 6.0     | <b>FROM TO</b>                                                                                                            |  |  |  | <b>PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)</b>                                                    |  |  |  |
| M BMWW-t                           | MT20   | 4.0 | 4.0     | <b>FR-TO</b>                                                                                                              |  |  |  | <b>MAX MIN MAX MIN MAX MIN</b>                                                                            |  |  |  |
| N BS-t                             | MT20   | 3.0 | 6.0     | <b>FR-TO</b>                                                                                                              |  |  |  | <b>MT20 618 354 1667 822 2284 1656</b>                                                                    |  |  |  |
| O BMWWW-t                          | MT20   | 4.0 | 9.0     | <b>FR-TO</b>                                                                                                              |  |  |  | <b>PLATE PLACEMENT TOL. = 0.250 inches</b>                                                                |  |  |  |
| P BS-t                             | MT20   | 3.0 | 6.0     | <b>FR-TO</b>                                                                                                              |  |  |  | <b>PLATE ROTATION TOL. = 5.0 Deg.</b>                                                                     |  |  |  |
| Q BMWW-t                           | MT20   | 4.0 | 4.0     | <b>FR-TO</b>                                                                                                              |  |  |  | <b>JSI GRIP= 0.89 (Q) (INPUT = 0.90)</b>                                                                  |  |  |  |
| R BMW-t                            | MT20   | 4.0 | 4.0     | <b>FR-TO</b>                                                                                                              |  |  |  | <b>JSI METAL= 0.60 (P) (INPUT = 1.00)</b>                                                                 |  |  |  |
| S BMVW1+p                          | MT20   | 5.0 | 6.0     | <b>FR-TO</b>                                                                                                              |  |  |  |                                                                                                           |  |  |  |

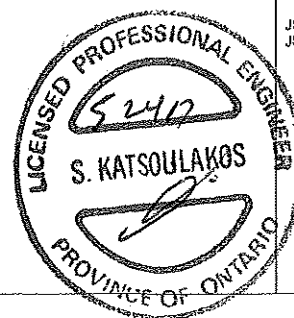

DWG NO. YAM25672-17  
STRUCTURAL  
COMPONENT ONLY

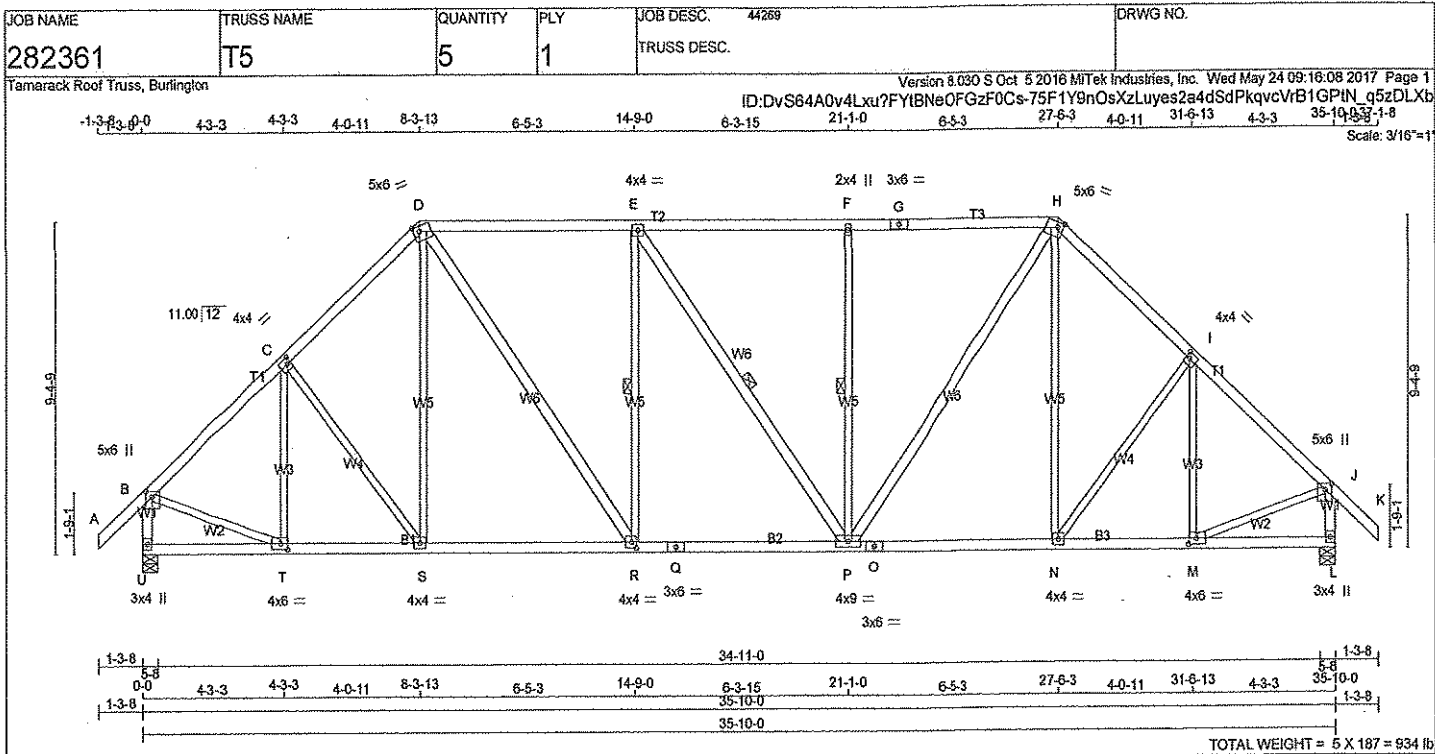

**LUMBER**

N. L. G. A. RULES

| CHORDS          | SIZE | LUMBER | DESCR. |
|-----------------|------|--------|--------|
| A - D           | 2x4  | DRY    | No.2   |
| D - G           | 2x4  | DRY    | No.2   |
| G - H           | 2x4  | DRY    | No.2   |
| H - K           | 2x4  | DRY    | No.2   |
| U - B           | 2x4  | DRY    | No.2   |
| L - J           | 2x4  | DRY    | No.2   |
| U - O           | 2x4  | DRY    | No.2   |
| Q - O           | 2x4  | DRY    | No.2   |
| O - L           | 2x4  | DRY    | No.2   |
| ALL WEBS EXCEPT | 2x3  | DRY    | No.2   |
| D - R           | 2x4  | DRY    | No.2   |
| E - P           | 2x4  | DRY    | No.2   |
| P - H           | 2x4  | DRY    | No.2   |

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

| JT TYPE   | PLATES | W   | LEN | Y    | X    |
|-----------|--------|-----|-----|------|------|
| B TMWW+p  | MT20   | 5.0 | 6.0 | 2.00 | 2.25 |
| C TMWW-l  | MT20   | 4.0 | 4.0 | 2.00 | 1.25 |
| D TTWW-m  | MT20   | 5.0 | 6.0 | 1.75 | 2.00 |
| E TMWW-l  | MT20   | 4.0 | 4.0 |      |      |
| F TMWW+w  | MT20   | 2.0 | 4.0 |      |      |
| G TS-l    | MT20   | 3.0 | 6.0 |      |      |
| H TTWW-m  | MT20   | 5.0 | 6.0 | 1.75 | 2.00 |
| I TMWW-l  | MT20   | 4.0 | 4.0 | 2.00 | 1.25 |
| J TMWW+p  | MT20   | 5.0 | 6.0 | 2.00 | 2.25 |
| L BMV1+p  | MT20   | 3.0 | 4.0 |      |      |
| M BMWW-l  | MT20   | 4.0 | 6.0 | 2.00 | 2.75 |
| N BMWW-l  | MT20   | 4.0 | 4.0 |      |      |
| O BS-l    | MT20   | 3.0 | 6.0 |      |      |
| P BMWWW-l | MT20   | 4.0 | 9.0 |      |      |
| Q BS-l    | MT20   | 3.0 | 6.0 |      |      |
| R BMWW-l  | MT20   | 4.0 | 4.0 | 2.00 | 1.75 |
| S BMWW-l  | MT20   | 4.0 | 4.0 |      |      |
| T BMWW-l  | MT20   | 4.0 | 6.0 | 2.00 | 2.75 |
| U BMV1+p  | MT20   | 3.0 | 4.0 |      |      |

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

|         | FACTORED GROSS REACTION | MAXIMUM FACTORED GROSS REACTION | INPUT BRG | REQD BRG |
|---------|-------------------------|---------------------------------|-----------|----------|
| JT VERT | 2128                    | 2128                            | 0         | 5-8      |
| U VERT  | 2128                    | 2128                            | 0         | 5-8      |
| L VERT  | 2128                    | 2128                            | 0         | 5-8      |

**UNFACTORED REACTIONS**

|             | 1ST CASE | MAX. MIN. COMPONENT REACTIONS |
|-------------|----------|-------------------------------|
| JT COMBINED | 1731     | 988 / 0                       |
| U COMBINED  | 1731     | 988 / 0                       |
| L COMBINED  | 1731     | 988 / 0                       |

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

**BRACING**

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.11 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-R, E-P, F-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

**LOADING**

TOTAL LOAD CASES: (4)

| CHORDS |                           |                           |                           | WEBS  |                           |                           |          |
|--------|---------------------------|---------------------------|---------------------------|-------|---------------------------|---------------------------|----------|
| MEMB.  | MAX. FACTORED FORCE (LBS) | FACTORED VERT. LOAD (PLF) | MAX. UNBRACED LENGTH (LC) | MEMB. | MAX. FACTORED FORCE (LBS) | MAX. UNBRACED LENGTH (LC) |          |
| FR-TO  |                           |                           |                           | FR-TO |                           |                           |          |
| A-B    | 0 / 40                    | -84.3                     | -84.3 0.12 (1)            | 10.00 | T-C                       | -357 / 0                  | 0.18 (1) |
| B-C    | -1951 / 0                 | -84.3                     | -84.3 0.33 (1)            | 4.53  | C-S                       | -55 / 0                   | 0.05 (1) |
| C-D    | -1966 / 0                 | -84.3                     | -84.3 0.32 (1)            | 4.51  | S-D                       | 0 / 281                   | 0.08 (2) |
| D-E    | -1968 / 0                 | -84.3                     | -84.3 0.32 (1)            | 4.11  | D-R                       | 0 / 937                   | 0.15 (1) |
| E-F    | -1968 / 0                 | -84.3                     | -84.3 0.62 (1)            | 4.12  | R-E                       | -582 / 0                  | 0.34 (1) |
| F-G    | -1967 / 0                 | -84.3                     | -84.3 0.60 (1)            | 4.15  | E-P                       | -3 / 0                    | 0.00 (1) |
| G-H    | -1967 / 0                 | -84.3                     | -84.3 0.60 (1)            | 4.15  | P-F                       | -579 / 0                  | 0.34 (1) |
| H-I    | -1967 / 0                 | -84.3                     | -84.3 0.32 (1)            | 4.51  | F-H                       | 0 / 933                   | 0.15 (1) |
| I-J    | -1950 / 0                 | -84.3                     | -84.3 0.33 (1)            | 4.53  | H-N                       | 0 / 281                   | 0.08 (2) |
| J-K    | 0 / 40                    | -84.3                     | -84.3 0.12 (1)            | 10.00 | N-I                       | -54 / 0                   | 0.05 (1) |
| U-B    | -2076 / 0                 | 0.0                       | 0.0 0.23 (1)              | 5.87  | M-I                       | -368 / 0                  | 0.18 (1) |
| L-J    | -2076 / 0                 | 0.0                       | 0.0 0.23 (1)              | 5.87  | B-T                       | 0 / 1536                  | 0.35 (1) |
|        |                           |                           |                           |       | M-J                       | 0 / 1535                  | 0.35 (1) |
| U-T    | 0 / 0                     | -28.0                     | -28.0 0.11 (2)            | 10.00 |                           |                           |          |
| T-S    | 0 / 1458                  | -28.0                     | -28.0 0.34 (2)            | 10.00 |                           |                           |          |
| S-R    | 0 / 1426                  | -28.0                     | -28.0 0.40 (2)            | 10.00 |                           |                           |          |
| R-Q    | 0 / 1968                  | -28.0                     | -28.0 0.46 (2)            | 10.00 |                           |                           |          |
| Q-P    | 0 / 1968                  | -28.0                     | -28.0 0.46 (2)            | 10.00 |                           |                           |          |
| P-O    | 0 / 1426                  | -28.0                     | -28.0 0.40 (2)            | 10.00 |                           |                           |          |
| O-N    | 0 / 1426                  | -28.0                     | -28.0 0.40 (2)            | 10.00 |                           |                           |          |
| N-M    | 0 / 1458                  | -28.0                     | -28.0 0.34 (2)            | 10.00 |                           |                           |          |
| M-L    | 0 / 0                     | -28.0                     | -28.0 0.11 (2)            | 10.00 |                           |                           |          |

**DESIGN CRITERIA**

**SPECIFIED LOADS:**

TOP CH. LL = 25.6 PSF  
DL = 3.0 PSF  
BOT CH. LL = 10.5 PSF  
DL = 7.0 PSF  
TOTAL LOAD = 46.1 PSF

**SPACING = 24.0 IN./C/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:  
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014  
- CSA 086-09  
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.19')  
CALCULATED VERT. DEFL.(LL) = L/999 (0.11')  
ALLOWABLE DEFL.(TL) = L/360 (1.19')  
CALCULATED VERT. DEFL.(TL) = L/999 (0.18')

CSI: TC=0.62 (D-E:1), BC=0.46 (P-R:2), WB=0.35 (B-T:1), SSI=0.25 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10  
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


**NAIL VALUES**

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)  
MAX MIN MAX MIN MAX MIN  
MT20 618 354 1667 622 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (D) (INPUT = 0.90)  
JSI METAL= 0.50 (Q) (INPUT = 1.00)

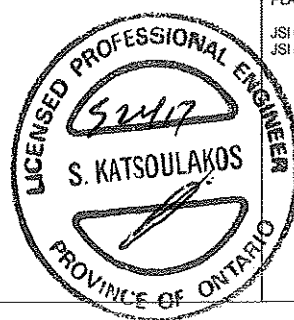

DWG NO. TAM25673-17  
STRUCTURAL  
COMPONENT ONLY



DRWG NO.

Scale = 1:30.6

TOTAL WEIGHT = 51 lb

UW0 NO. TAM25675-17  
STRUCTURAL  
COMPONENT ONLY

JSI GRIP= 0.63 (G) (INPUT = 0.90 )  
JSI METAL= 0.21 (B) (INPUT = 1.00 )


|          |            |          |     |             |       |          |
|----------|------------|----------|-----|-------------|-------|----------|
| JOB NAME | TRUSS NAME | QUANTITY | PLY | JOB DESC.   | 44269 | DRWG NO. |
| 282361   | T8         | 1        | 1   | TRUSS DESC. |       |          |

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 Mitek Industries, Inc. Wed May 24 09:16:09 2017 Page 1

ID: DvS64A0v4Lxu7FY1BNe0FGzF0Cs-bloPmUo1dq5CV6D3cHbs\_ryx8Jyjaal.QeX7XMYzDLXa

Scale = 1:34.3

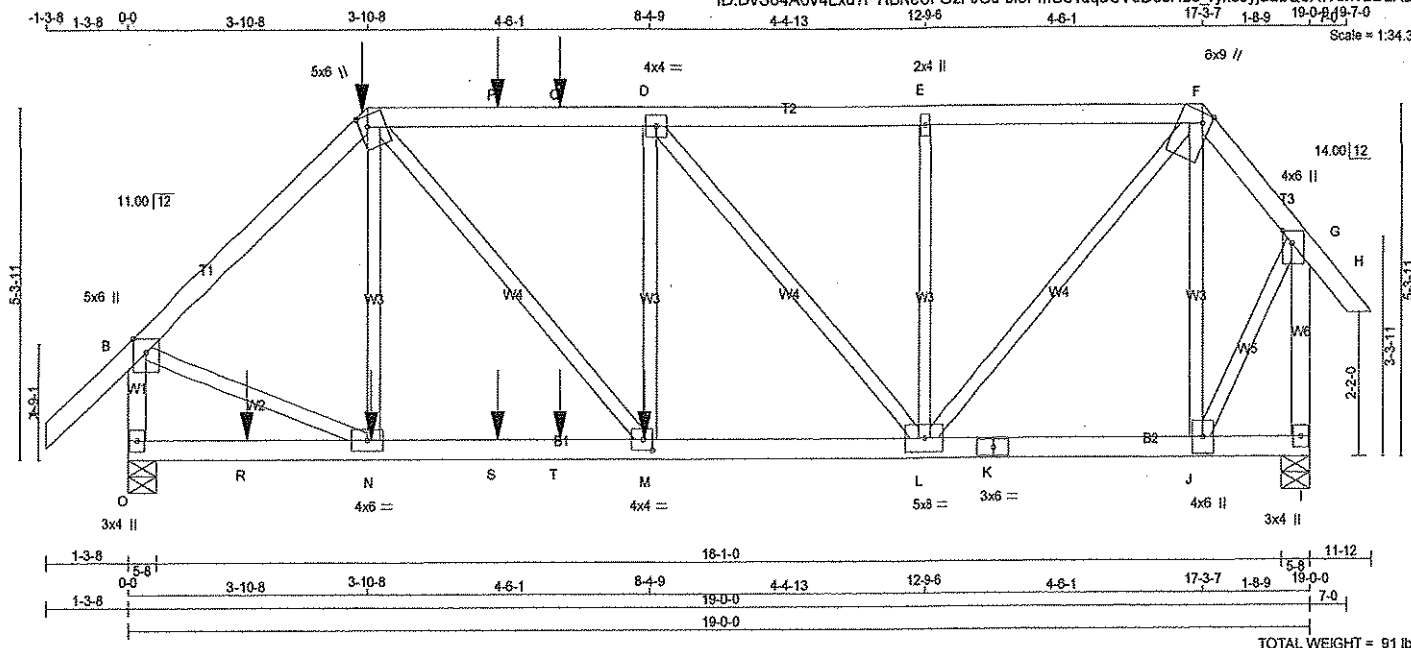

| LUMBER          | N. L. G. A. RULES | CHORDS | SIZE | DRY | LUMBER | DESCR. |
|-----------------|-------------------|--------|------|-----|--------|--------|
| A - C           | 2x4               | DRY    | No.2 | SPF |        |        |
| C - F           | 2x4               | DRY    | No.2 | SPF |        |        |
| F - H           | 2x4               | DRY    | No.2 | SPF |        |        |
| O - B           | 2x4               | DRY    | No.2 | SPF |        |        |
| I - G           | 2x4               | DRY    | No.2 | SPF |        |        |
| O - K           | 2x4               | DRY    | No.2 | SPF |        |        |
| K - I           | 2x4               | DRY    | No.2 | SPF |        |        |
| ALL WEBS EXCEPT | 2x3               | DRY    | No.2 | SPF |        |        |

DRY: SEASONED LUMBER.

#### PLATES (table is in inches)

| JT | TYPE    | PLATES | W   | LEN | Y    | X    |
|----|---------|--------|-----|-----|------|------|
| B  | TMVW+p  | MT20   | 5.0 | 6.0 | Edge |      |
| C  | TTWW+m  | MT20   | 5.0 | 6.0 | 2.00 | 1.50 |
| D  | TMWW-l  | MT20   | 4.0 | 4.0 |      |      |
| E  | TMW+w   | MT20   | 2.0 | 4.0 |      |      |
| F  | TTWW+m  | MT20   | 6.0 | 9.0 | Edge | 1.50 |
| G  | TMVW+p  | MT20   | 4.0 | 6.0 | 2.25 | 1.75 |
| I  | BMV1+p  | MT20   | 3.0 | 4.0 |      |      |
| J  | BMWW+l  | MT20   | 4.0 | 6.0 |      |      |
| K  | BS-l    | MT20   | 3.0 | 6.0 |      |      |
| L  | BMWWW-l | MT20   | 5.0 | 8.0 |      |      |
| M  | BMWW-l  | MT20   | 4.0 | 4.0 | 2.00 | 1.75 |
| N  | BMWW-l  | MT20   | 4.0 | 6.0 |      |      |
| O  | BMV1+p  | MT20   | 3.0 | 4.0 |      |      |

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

#### HANGERS NOTES

- SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 265.9 lbs FACTORED DOWN AT 3-10-8, AND 79.0 lbs FACTORED DOWN AT 5-11-4, AND 79.0 lbs FACTORED DOWN AT 6-11-4 ON TOP CHORD, AND 42.3 lbs FACTORED DOWN AT 1-11-4, 42.3 lbs FACTORED DOWN AT 3-11-4, 42.3 lbs FACTORED DOWN AT 5-11-4, AND 42.3 lbs FACTORED DOWN AT 6-11-4, AND 622.1 lbs FACTORED DOWN AT 8-3-8 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

#### DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

##### BEARINGS

|    | FACTORED GROSS REACTION | MAXIMUM FACTORED GROSS REACTION | INPUT BRG | REQRD BRG |
|----|-------------------------|---------------------------------|-----------|-----------|
| JT | VERT                    | HORZ                            | DOWN      | UPLIFT    |
| O  | 1920                    | 0                               | 1920      | 0         |
| I  | 1545                    | 0                               | 1545      | 0         |

##### UNFACTORED REACTIONS

| JT | 1ST CASE | SNOW  | LIVE  | PERM LIVE | WIND | DEAD  | SOIL |
|----|----------|-------|-------|-----------|------|-------|------|
| O  | 1541     | 911/0 | 311/0 | 0/0       | 0/0  | 318/0 | 0/0  |
| I  | 1249     | 725/0 | 263/0 | 0/0       | 0/0  | 262/0 | 0/0  |

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, I

##### BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.29 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

##### LOADING

TOTAL LOAD CASES: (4)

| CHORDS | MEMB.   | MAX. FACTORED FORCE (LBS) | FACTORED VERT. LOAD (PLF) | MAX. FACTORED VERT. LOAD (LBS) | MAX. FACTORED VERT. LOAD (LBS) | MAX. FACTORED VERT. LOAD (LBS) | MAX. FACTORED VERT. LOAD (LBS) | MAX. FACTORED VERT. LOAD (LBS) | MAX. FACTORED VERT. LOAD (LBS) |
|--------|---------|---------------------------|---------------------------|--------------------------------|--------------------------------|--------------------------------|--------------------------------|--------------------------------|--------------------------------|
| FR-TO  |         |                           |                           |                                |                                |                                |                                |                                |                                |
| A-B    | 0/40    | -84.3                     | -84.3                     | 0.13 (1)                       | 10.00                          | N-C                            | -241/137                       | 0.10 (1)                       |                                |
| B-C    | -1693/0 | -84.3                     | -84.3                     | 0.31 (1)                       | 4.76                           | C-M                            | 0/998                          | 0.25 (1)                       |                                |
| C-P    | -1907/0 | -84.3                     | -84.3                     | 0.46 (1)                       | 4.29                           | M-D                            | 0/204                          | 0.05 (3)                       |                                |
| P-Q    | -1907/0 | -84.3                     | -84.3                     | 0.46 (1)                       | 4.29                           | D-L                            | -728/0                         | 0.60 (1)                       |                                |
| Q-D    | -1907/0 | -84.3                     | -84.3                     | 0.46 (1)                       | 4.29                           | L-E                            | -376/0                         | 0.16 (1)                       |                                |
| D-E    | -1428/0 | -84.3                     | -84.3                     | 0.38 (1)                       | 4.66                           | L-F                            | 0/1406                         | 0.35 (1)                       |                                |
| E-F    | -1428/0 | -84.3                     | -84.3                     | 0.27 (1)                       | 5.13                           | J-F                            | -693/0                         | 0.30 (1)                       |                                |
| F-G    | -775/0  | -84.3                     | -84.3                     | 0.05 (1)                       | 6.25                           | B-N                            | 0/1320                         | 0.33 (1)                       |                                |
| G-H    | 0/28    | -84.3                     | -84.3                     | 0.05 (1)                       | 10.00                          | J-G                            | 0/947                          | 0.23 (1)                       |                                |
| O-B    | -1870/0 | 0.0                       | 0.0                       | 0.22 (1)                       | 6.09                           |                                |                                |                                |                                |
| I-G    | -1544/0 | 0.0                       | 0.0                       | 0.31 (1)                       | 6.58                           |                                |                                |                                |                                |
| O-R    | 0/0     | -28.0                     | -28.0                     | 0.19 (2)                       | 10.00                          |                                |                                |                                |                                |
| R-N    | 0/0     | -28.0                     | -28.0                     | 0.19 (2)                       | 10.00                          |                                |                                |                                |                                |
| N-S    | 0/1239  | -28.0                     | -28.0                     | 0.35 (2)                       | 10.00                          |                                |                                |                                |                                |
| S-T    | 0/1239  | -28.0                     | -28.0                     | 0.35 (2)                       | 10.00                          |                                |                                |                                |                                |
| T-M    | 0/1239  | -28.0                     | -28.0                     | 0.35 (2)                       | 10.00                          |                                |                                |                                |                                |
| M-L    | 0/1908  | -28.0                     | -28.0                     | 0.40 (1)                       | 10.00                          |                                |                                |                                |                                |
| L-K    | 0/484   | -28.0                     | -28.0                     | 0.17 (2)                       | 10.00                          |                                |                                |                                |                                |
| K-J    | 0/484   | -28.0                     | -28.0                     | 0.17 (2)                       | 10.00                          |                                |                                |                                |                                |
| J-I    | 0/0     | -28.0                     | -28.0                     | 0.10 (2)                       | 10.00                          |                                |                                |                                |                                |

##### FACTORED CONCENTRATED LOADS (LBS)

| JT | LOC.   | LC1  | MAX- | MAX+ | FACE  | DIR. | TYPE  |
|----|--------|------|------|------|-------|------|-------|
| C  | 3-10-8 | -266 | -266 |      | FRONT | VERT | TOTAL |
| M  | 8-3-8  | -622 | -622 |      | FRONT | VERT | TOTAL |
| N  | 3-11-4 | -24  | -24  |      | FRONT | VERT | TOTAL |
| P  | 5-11-4 | -79  | -79  |      | FRONT | VERT | TOTAL |
| Q  | 6-11-4 | -79  | -79  |      | FRONT | VERT | TOTAL |
| R  | 1-11-4 | -24  | -24  |      | FRONT | VERT | TOTAL |
| S  | 5-11-4 | -24  | -24  |      | FRONT | VERT | TOTAL |
| T  | 6-11-4 | -24  | -24  |      | FRONT | VERT | TOTAL |

#### DESIGN CRITERIA

##### SPECIFIED LOADS:

|            |    |   |      |     |
|------------|----|---|------|-----|
| TOP CH.    | LL | = | 25.6 | PSF |
|            | DL | = | 3.0  | PSF |
| BOT CH.    | LL | = | 10.5 | PSF |
|            | DL | = | 7.0  | PSF |
| TOTAL LOAD |    | = | 46.1 | PSF |

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:  
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014  
- CSA 088-09  
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) =  $L/360$  (0.63")  
CALCULATED VERT. DEFL.(LL) =  $L/999$  (0.06")  
ALLOWABLE DEFL.(TL) =  $L/360$  (0.63")  
CALCULATED VERT. DEFL.(TL) =  $L/999$  (0.09")

CSI: TC=0.48 (C-D:1), BC=0.40 (L-M:1), WB=0.60 (D-L:1), GSI=0.28 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

##### NAIL VALUES


| PLATE   | GRIP(DRY) | SHEAR   | SECTION |
|---------|-----------|---------|---------|
| (PSI)   | (PLI)     | (PLI)   |         |
| MAX MIN | MAX MIN   | MAX MIN |         |
| MT20    | 618       | 354     | 1667    |
|         | 822       | 2284    | 1656    |


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (M) (INPUT = 0.90)  
JSI METAL= 0.31 (B) (INPUT = 1.00)

DRWG NO. TAM25676-1  
STRUCTURAL  
COMPONENT ONLY

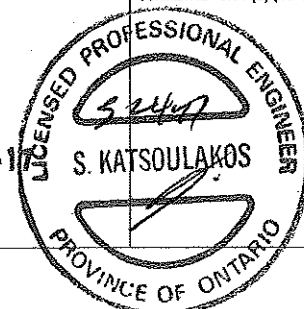

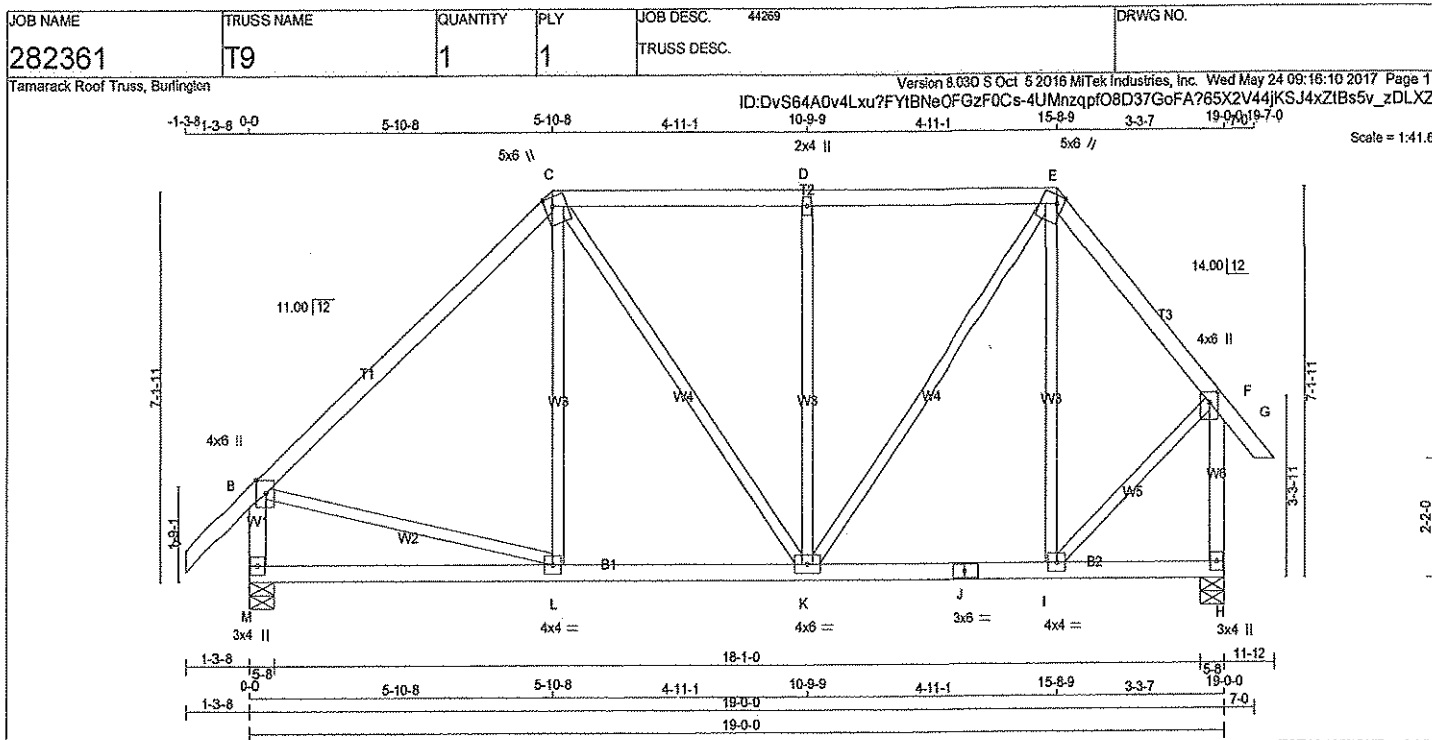

| LUMBER            |        |      |        |
|-------------------|--------|------|--------|
| N. L. G. A. RULES | CHORDS | SIZE | DESCR. |
| A - C             | 2x4    | DRY  | No.2   |
| C - E             | 2x4    | DRY  | No.2   |
| E - G             | 2x4    | DRY  | No.2   |
| M - B             | 2x4    | DRY  | No.2   |
| H - F             | 2x4    | DRY  | No.2   |
| M - J             | 2x4    | DRY  | No.2   |
| J - H             | 2x4    | DRY  | No.2   |

ALL WEBS 2x3 DRY No.2 SPF  
EXCEPT

DRY: SEASONED LUMBER.

| PLATES (table is in inches) |        |        |     |     |           |
|-----------------------------|--------|--------|-----|-----|-----------|
| JT                          | TYPE   | PLATES | W   | LEN | Y X       |
| B                           | TMVW+p | MT20   | 4.0 | 6.0 | Edge      |
| C                           | TTWW+m | MT20   | 5.0 | 6.0 | 2.00 1.75 |
| D                           | TMW+w  | MT20   | 2.0 | 4.0 |           |
| E                           | TTWW+m | MT20   | 5.0 | 6.0 | 1.75 1.50 |
| F                           | TMVW+p | MT20   | 4.0 | 6.0 | 2.25 2.00 |
| H                           | BMV1+p | MT20   | 3.0 | 4.0 |           |
| I                           | BMWW-t | MT20   | 4.0 | 4.0 |           |
| J                           | BS-t   | MT20   | 3.0 | 6.0 |           |
| K                           | BMWW-t | MT20   | 4.0 | 6.0 |           |
| L                           | BMWW-t | MT20   | 4.0 | 4.0 |           |
| M                           | BMV1+p | MT20   | 3.0 | 4.0 |           |

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

#### DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

| BEARINGS |      | FACTORED       | MAXIMUM FACTORED | INPUT | REQD |
|----------|------|----------------|------------------|-------|------|
| JT       | VERT | GROSS REACTION | GROSS REACTION   | BRG   | BRG  |
| M        | 1184 | 0              | 1184             | 0     | 5-8  |
| H        | 1139 | 0              | 1139             | 0     | 5-8  |

| UNFACTORED REACTIONS |          | 1ST LCASE | MAX. MIN. COMPONENT REACTIONS  |
|----------------------|----------|-----------|--------------------------------|
| JT                   | COMBINED | SNOW      | LIVE PERM. LIVE WIND DEAD SOIL |
| M                    | 955      | 557 / 0   | 200 / 0 0 / 0 198 / 0 0 / 0    |
| H                    | 925      | 530 / 0   | 200 / 0 0 / 0 195 / 0 0 / 0    |

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, H

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.68 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

#### LOADING

| TOTAL LOAD CASES: (4) |             | CHORDS           | FACTORED   | WEBS  | FACTORED    |
|-----------------------|-------------|------------------|------------|-------|-------------|
| MEMB.                 | FORCE (LBS) | VERT. LOAD (PLF) | MAX. (LC1) | MEMB. | FORCE (LBS) |
| FR-TO                 |             | FROM TO          | LENGTH     | FR-TO |             |
| A-B                   | 0 / 40      | -84.3 -84.3      | 0.12 (1)   | L-C   | 0 / 229     |
| B-C                   | -882 / 0    | -84.3 -84.3      | 0.58 (1)   | C-K   | 0 / 201     |
| C-D                   | -768 / 0    | -84.3 -84.3      | 0.35 (1)   | K-D   | -503 / 0    |
| D-E                   | -768 / 0    | -84.3 -84.3      | 0.35 (1)   | K-E   | 0 / 567     |
| E-F                   | -677 / 0    | -84.3 -84.3      | 0.17 (1)   | I-E   | -246 / 31   |
| F-G                   | 0 / 28      | -84.3 -84.3      | 0.05 (1)   | B-L   | 0 / 667     |
| M-B                   | -1115 / 0   | 0.0 0.0          | 0.12 (1)   | I-F   | 0 / 580     |
| H-F                   | -1108 / 0   | 0.0 0.0          | 0.21 (1)   |       |             |
| M-L                   | 0 / 0       | -28.0 -28.0      | 0.22 (3)   |       |             |
| L-K                   | 0 / 649     | -28.0 -28.0      | 0.30 (2)   |       |             |
| K-J                   | 0 / 434     | -28.0 -28.0      | 0.17 (2)   |       |             |
| J-I                   | 0 / 434     | -28.0 -28.0      | 0.17 (2)   |       |             |
| I-H                   | 0 / 0       | -28.0 -28.0      | 0.12 (2)   |       |             |

#### DESIGN CRITERIA

**SPECIFIED LOADS:**  
TOP CH. LL = 25.6 PSF  
DL = 3.0 PSF  
BOT CH. LL = 10.5 PSF  
DL = 7.0 PSF  
TOTAL LOAD = 46.1 PSF

**SPACING = 24.0 IN. C/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:  
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014  
- CSA 086-09  
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) =  $L/360$  (0.63")  
CALCULATED VERT. DEFL.(LL) =  $L/999$  (0.05")  
ALLOWABLE DEFL.(TL) =  $L/360$  (0.63")  
CALCULATED VERT. DEFL.(TL) =  $L/999$  (0.05")

CSI: TC=0.58 (B-C:1), BC=0.30 (K-L:2), WB=0.45 (D-K:1), SSI=0.20 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10  
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**  
PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL)  
MAX MIN MAX MIN MAX MIN  
MT20 618 354 1667 822 2284 1655

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg

JSI GRIP= 0.81 (B) (INPUT = 0.90)  
JSI METAL= 0.24 (L) (INPUT = 1.00)

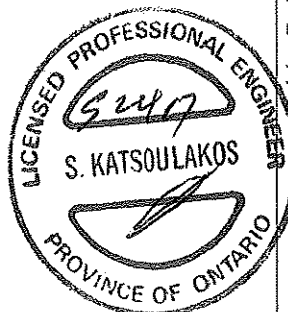

DRWG NO. YAM2567217  
STRUCTURAL  
COMPONENT ONLY




|          |            |          |     |             |       |          |
|----------|------------|----------|-----|-------------|-------|----------|
| JOB NAME | TRUSS NAME | QUANTITY | PLY | JOB DESC.   | 44269 | DRWG NO. |
| 282361   | T10        | 2        | 1   | TRUSS DESC. |       |          |

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 MiTek Industries, Inc. Wed May 24 09:16:10 2017 Page 1

ID:DvS64A0v4Lxu?FYIBNeOFGzFCs-4UMnzqpf08D37GoFA?65X2V7OjHrJ74ZiBs5v\_zDLXZ

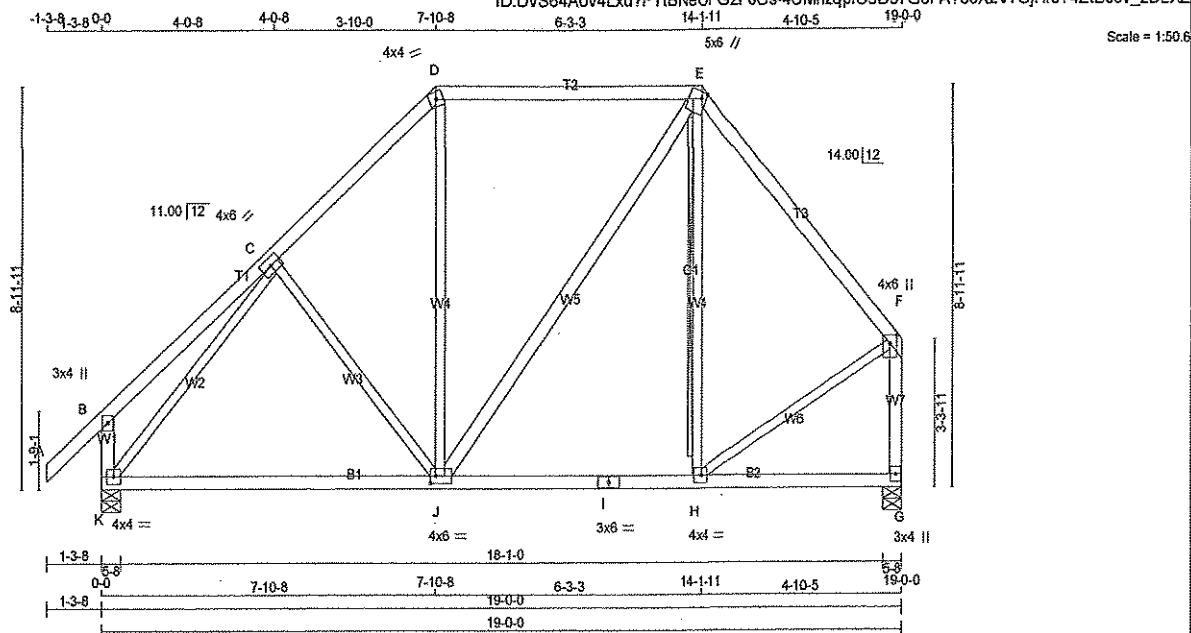

TOTAL WEIGHT = 2 X 97 = 193 lb

| LUMBER | N. L. G. A. RULES | CHORDS | SIZE | LUMBER | DESCR. |
|--------|-------------------|--------|------|--------|--------|
| A - D  | 2x4 DRY           | No.2   | SPF  |        |        |
| D - E  | 2x4 DRY           | No.2   | SPF  |        |        |
| E - F  | 2x4 DRY           | No.2   | SPF  |        |        |
| K - B  | 2x4 DRY           | No.2   | SPF  |        |        |
| G - F  | 2x4 DRY           | No.2   | SPF  |        |        |
| K - I  | 2x4 DRY           | No.2   | SPF  |        |        |
| I - G  | 2x4 DRY           | No.2   | SPF  |        |        |

|          |         |      |     |
|----------|---------|------|-----|
| ALL WEBS | 2x3 DRY | No.2 | SPF |
| EXCEPT   |         |      |     |
| J - E    | 2x4 DRY | No.2 | SPF |

DRY: SEASONED LUMBER.

#### PLATES (table is in inches)

| JT | TYPE    | PLATES | W   | LEN | Y    | X    |
|----|---------|--------|-----|-----|------|------|
| B  | TMV+p   | MT20   | 3.0 | 4.0 |      |      |
| C  | TMWW-t  | MT20   | 4.0 | 6.0 |      |      |
| D  | TTW-m   | MT20   | 4.0 | 4.0 |      |      |
| E  | TTWW+m  | MT20   | 5.0 | 6.0 | 1.75 | 1.50 |
| F  | TMVW+p  | MT20   | 4.0 | 6.0 | 2.25 | 2.00 |
| G  | BMV1+p  | MT20   | 3.0 | 4.0 |      |      |
| H  | BMWW-t  | MT20   | 4.0 | 4.0 |      |      |
| I  | BS-t    | MT20   | 3.0 | 6.0 |      |      |
| J  | BMWWW-t | MT20   | 4.0 | 6.0 | 2.00 | 1.50 |
| K  | BMVW1-t | MT20   | 4.0 | 4.0 |      |      |

#### DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

| BEARINGS |      | FACTORED       |      | MAXIMUM FACTORED |      | INPUT |       | REQRD |       |
|----------|------|----------------|------|------------------|------|-------|-------|-------|-------|
| JT       | VERT | GROSS REACTION | DOWN | GROSS REACTION   | DOWN | BRG   | IN-SX | BRG   | IN-SX |
| K        | 1184 | 0              | 1184 | 0                | 0    | 5-8   | 5-8   |       |       |
| G        | 1066 | 0              | 1066 | 0                | 0    | 5-8   | 5-8   |       |       |

#### UNFACTORED REACTIONS

| JT | 1ST LCASE | SNOW    | LIVE    | PERM LIVE | WIND  | DEAD    | SOIL  |
|----|-----------|---------|---------|-----------|-------|---------|-------|
| K  | 955       | 557 / 0 | 200 / 0 | 0 / 0     | 0 / 0 | 198 / 0 | 0 / 0 |
| G  | 876       | 486 / 0 | 200 / 0 | 0 / 0     | 0 / 0 | 190 / 0 | 0 / 0 |

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, G

#### BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x3 DRY SPF No.2 T-BRACE AT E-H

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

#### LOADING

TOTAL LOAD CASES: (4)

| CHORDS |                           |                           |                           | WEBS  |                           |                           |                           |
|--------|---------------------------|---------------------------|---------------------------|-------|---------------------------|---------------------------|---------------------------|
| MEMB.  | MAX. FACTORED FORCE (LBS) | FACTORED VERT. LOAD (PLF) | MAX. UNBRACED LENGTH (FT) | MEMB. | MAX. FACTORED FORCE (LBS) | MAX. UNBRACED LENGTH (FT) | MAX. UNBRACED LENGTH (FT) |
| FR-TO  |                           | FROM TO                   |                           | FR-TO |                           |                           |                           |
| A-B    | 0 / 40                    | -84.3 -84.3               | 0.12 (1)                  | 10.00 | C-J                       | -127 / 50                 | 0.10 (1)                  |
| B-C    | 0 / 28                    | -84.3 -84.3               | 0.21 (1)                  | 10.00 | J-D                       | 0 / 258                   | 0.06 (2)                  |
| C-D    | -821 / 0                  | -84.3 -84.3               | 0.17 (1)                  | 6.25  | J-E                       | 0 / 227                   | 0.04 (1)                  |
| D-E    | -588 / 0                  | -84.3 -84.3               | 0.43 (1)                  | 6.25  | H-E                       | -120 / 121                | 0.16 (1)                  |
| E-F    | -703 / 0                  | -84.3 -84.3               | 0.27 (1)                  | 6.25  | K-C                       | -1079 / 0                 | 0.76 (1)                  |
| K-B    | -243 / 0                  | 0.0 0.0                   | 0.93 (1)                  | 7.81  | H-F                       | 0 / 529                   | 0.12 (1)                  |
| G-F    | -1009 / 0                 | 0.0 0.0                   | 0.19 (1)                  | 7.79  |                           |                           |                           |
| K-J    | 0 / 685                   | -28.0 -28.0               | 0.47 (2)                  | 10.00 |                           |                           |                           |
| J-I    | 0 / 454                   | -28.0 -28.0               | 0.45 (2)                  | 10.00 |                           |                           |                           |
| I-H    | 0 / 454                   | -28.0 -28.0               | 0.45 (2)                  | 10.00 |                           |                           |                           |
| H-G    | 0 / 0                     | -28.0 -28.0               | 0.15 (3)                  | 10.00 |                           |                           |                           |

#### DESIGN CRITERIA

##### SPECIFIED LOADS:

|              |               |
|--------------|---------------|
| TOP CH.      | LL = 25.6 PSF |
| DL = 3.0 PSF |               |
| BOT CH.      | LL = 10.5 PSF |
| DL = 7.0 PSF |               |
| TOTAL LOAD   | = 46.1 PSF    |

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.63")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.15")  
ALLOWABLE DEFL.(TL) = L/360 (0.63")  
CALCULATED VERT. DEFL.(TL) = L/898 (0.25")

CSI: TC=0.43 (D-E:1), BC=0.47 (J-K:2), WB=0.76 (C-K:1), SSI=0.21 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10  
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


#### NAIL VALUES

| PLATE   | GRIP(DRY) | SHEAR    | SECTION   |
|---------|-----------|----------|-----------|
| (PSI)   | (PLI)     | (PLI)    | (PLI)     |
| MAX MIN | MAX MIN   | MAX MIN  | MAX MIN   |
| MT20    | 618 354   | 1667 822 | 2284 1656 |

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (K) (INPUT = 0.90)  
JSI METAL= 0.27 (C) (INPUT = 1.00)

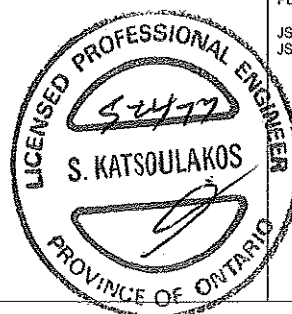

DWG NO. TAM 2567B-17  
STRUCTURAL  
COMPONENT ONLY



DWG NO. TAM 25679-17  
STRUCTURAL  
COMPONENT ONLY

|                           |                          |                      |                 |                                |          |
|---------------------------|--------------------------|----------------------|-----------------|--------------------------------|----------|
| JOB NAME<br><b>282361</b> | TRUSS NAME<br><b>T13</b> | QUANTITY<br><b>1</b> | PLY<br><b>1</b> | JOB DESC. 44289<br>TRUSS DESC. | DRWG NO. |
|---------------------------|--------------------------|----------------------|-----------------|--------------------------------|----------|

Tamarack Roof Truss, Burlington


Version 6.030 S Oct 5 2016 MiTek Industries, Inc. Wed May 24 09:16:10 2017 Page 1

ID: DvS64A0v4Lxu7FY1BNe0FGzF0Cs-4UMnzqp08D37GoFA?65X2V82jKzJ9IZtBs5v\_zDLXZ

0-0 5-5-0 5-5-0 5-5-0 10-10-0

4x6 ||

Scale = 1:46.6

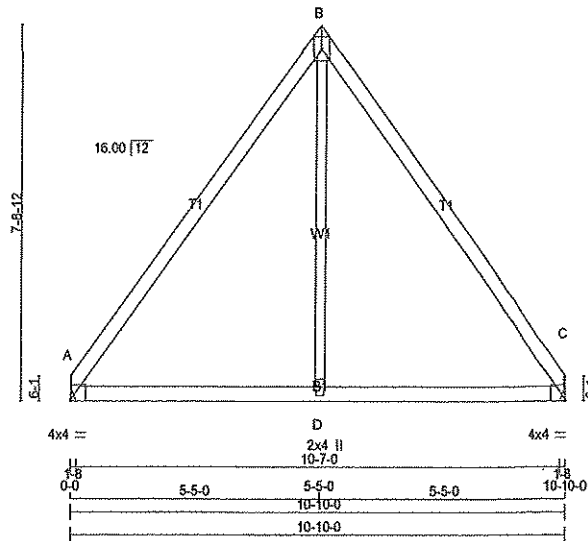

TOTAL WEIGHT = 39 lb

[MIF]

| LUMBER                | N. L. G. A. RULES | CHORDS | SIZE | LUMBER | DESCR. |
|-----------------------|-------------------|--------|------|--------|--------|
| A - B                 | 2x4               | DRY    | No.2 | SPF    |        |
| B - C                 | 2x4               | DRY    | No.2 | SPF    |        |
| A - C                 | 2x4               | DRY    | No.2 | SPF    |        |
| ALL WEBS              | 2x3               | DRY    | No.2 | SPF    |        |
| DRY: SEASONED LUMBER. |                   |        |      |        |        |

| PLATES (table is in inches) | JT     | TYPE | PLATES | W   | LEN  | Y | X |
|-----------------------------|--------|------|--------|-----|------|---|---|
| A                           | TMB1-i | MT20 | 4.0    | 4.0 | 0.25 |   |   |
| B                           | TTW+p  | MT20 | 4.0    | 6.0 |      |   |   |
| C                           | TMB1-i | MT20 | 4.0    | 4.0 | 0.25 |   |   |
| D                           | BMW+w  | MT20 | 2.0    | 4.0 |      |   |   |

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

| BEARINGS | FACTORED       | MAXIMUM FACTORED | INPUT | REQRD |
|----------|----------------|------------------|-------|-------|
|          | GROSS REACTION | GROSS REACTION   | BRG   | BRG   |
| JT       | VERT           | DOWN             | HORZ  | IN-SX |
| A        | 608            | 0                | 0     | 0     |
| C        | 608            | 0                | 0     | 0     |

#### UNFACTORED REACTIONS

| 1ST LCASE | MAX/MIN. COMPONENT REACTIONS |         |         |           |       |         |       |
|-----------|------------------------------|---------|---------|-----------|-------|---------|-------|
| JT        | COMBINED                     | SNOW    | LIVE    | PERM.LIVE | WIND  | DEAD    | SOIL  |
| A         | 499                          | 277 / 0 | 114 / 0 | 0 / 0     | 0 / 0 | 108 / 0 | 0 / 0 |
| C         | 499                          | 277 / 0 | 114 / 0 | 0 / 0     | 0 / 0 | 108 / 0 | 0 / 0 |

#### BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

#### LOADING

TOTAL LOAD CASES: (4)

| CHORDS |                           |                           |       |               | WEBS               |       |                           |               |  |
|--------|---------------------------|---------------------------|-------|---------------|--------------------|-------|---------------------------|---------------|--|
| MEMB.  | MAX. FACTORED FORCE (LBS) | FACTORED VERT. LOAD (PLF) | LC1   | MAX. CSI (LC) | MAX. UNBRAC LENGTH | MEMB. | MAX. FACTORED FORCE (LBS) | MAX. CSI (LC) |  |
| FR-TO  |                           | FROM                      | TO    |               |                    | FR-TO |                           |               |  |
| A-B    | -400 / 0                  | -84.3                     | -84.3 | 0.32 (1)      | 6.25               | D-B   | 0 / 330                   | 0.07 (3)      |  |
| B-C    | -400 / 0                  | -84.3                     | -84.3 | 0.32 (1)      | 6.25               |       |                           |               |  |
| A-D    | 0 / 238                   | -28.0                     | -28.0 | 0.27 (2)      | 10.00              |       |                           |               |  |
| D-C    | 0 / 238                   | -28.0                     | -28.0 | 0.27 (2)      | 10.00              |       |                           |               |  |

#### DESIGN CRITERIA

SPECIFIED LOADS:  
TOP CH. LL = 25.6 PSF  
DL = 3.0 PSF  
BOT CH. LL = 10.5 PSF  
DL = 7.0 PSF  
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:  
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014  
- CSA 088-09  
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) =  $L/360$  (0.36")  
CALCULATED VERT. DEFL.(LL) =  $L/999$  (0.03")  
ALLOWABLE DEFL.(TL) =  $L/360$  (0.36")  
CALCULATED VERT. DEFL.(TL) =  $L/999$  (0.04")

CSI: TC=0.32 (A-B:1), BC=0.27 (C-D:2), WB=0.07 (B-D:3), SSI=0.13 (A-D:3)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10  
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

| NAIL VALUES | PLATE    | GRIP(DRY) | SHEAR    | SECTION       |
|-------------|----------|-----------|----------|---------------|
|             | (FSI)    | (PLI)     | (PLI)    |               |
|             | MAX. MIN | MAX. MIN  | MAX. MIN |               |
| MT20        | 618      | 354       | 1667     | 822 2284 1656 |

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.50 (C) (INPUT = 0.90)  
JSI METAL= 0.13 (C) (INPUT = 1.00)

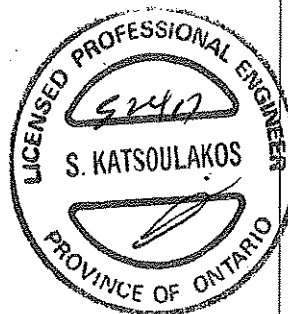

DWG NO. TAM25680-17  
STRUCTURAL  
COMPONENT ONLY

|          |            |          |     |             |          |
|----------|------------|----------|-----|-------------|----------|
| JOB NAME | TRUSS NAME | QUANTITY | PLY | JOB DESC.   | DRWG NO. |
| 282361   | T13S       | 3        | 1   | TRUSS DESC. |          |

Tamarack Roof Truss, Burlington


Version 8.030 S Oct 5 2016 MiTek Industries, Inc. Wed May 24 09:16:11 2017 Page 1

ID: DvS64A0v4Lxu?FYIBNe0FGzF0Cs-Ygw9BAPh9SLwIQNRjK4G1K7g7g2cJj5rceRQzDLXY

-7-9-0 5-5-0 5-5-0 5-5-0 10-10-0 11-5-0

4x6 II

Scale: 1/4"=1'

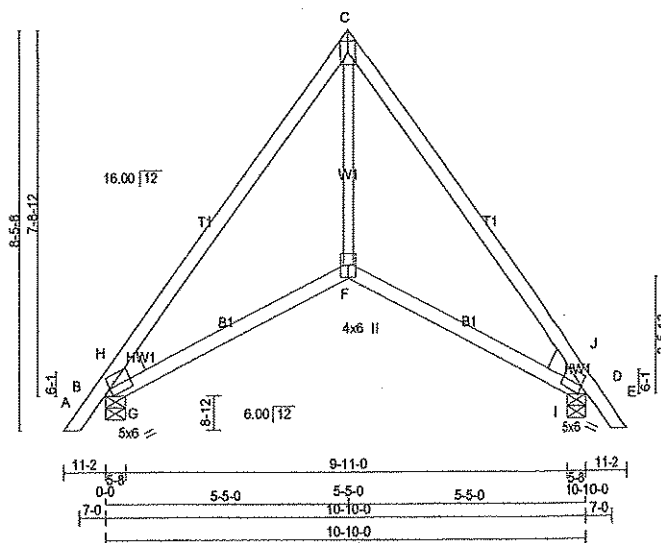

TOTAL WEIGHT = 3 X 45 = 135 lb

#### LUMBER

| N. L. G. A. RULES     | CHORDS | SIZE | LUMBER | DESCR. |
|-----------------------|--------|------|--------|--------|
| A - C                 | 2x4    | DRY  | No.2   | SPF    |
| C - E                 | 2x4    | DRY  | No.2   | SPF    |
| B - F                 | 2x4    | DRY  | No.2   | SPF    |
| F - D                 | 2x4    | DRY  | No.2   | SPF    |
| ALL WEBS              | 2x3    | DRY  | No.2   | SPF    |
| DRY: SEASONED LUMBER. |        |      |        |        |

#### PLATES (table is in inches)

| JT | TYPE    | PLATES | W   | LEN | Y    | X    |
|----|---------|--------|-----|-----|------|------|
| B  | TMBH1-I | MT20   | 5.0 | 6.0 | Edge | 0.25 |
| C  | TTW+p   | MT20   | 4.0 | 6.0 |      |      |
| D  | TMBH1-I | MT20   | 5.0 | 6.0 | Edge | 0.25 |
| F  | BBW+p   | MT20   | 4.0 | 6.0 |      |      |

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

#### DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

##### BEARINGS

| JT | FACTORED GROSS REACTION | MAXIMUM FACTORED GROSS REACTION | INPUT BRG | REQRD BRG | HEEL  |
|----|-------------------------|---------------------------------|-----------|-----------|-------|
| B  | 676                     | 0                               | 0         | 5-8       | 2x6 L |
| D  | 676                     | 0                               | 0         | 5-8       | 2x6 R |

##### UNFACTORED REACTIONS

| JT | 1ST LCASE | SNOW    | LIVE    | PERM.LIVE | WIND  | DEAD    | SOIL  |
|----|-----------|---------|---------|-----------|-------|---------|-------|
| B  | COMBINED  | 319 / 0 | 114 / 0 | 0 / 0     | 0 / 0 | 113 / 0 | 0 / 0 |
| D  | COMBINED  | 319 / 0 | 114 / 0 | 0 / 0     | 0 / 0 | 113 / 0 | 0 / 0 |

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

##### BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

##### LOADING

TOTAL LOAD CASES: (4)

| CHORDS |             | FACTORED   |         | WEBS  |             | FACTORED   |         |
|--------|-------------|------------|---------|-------|-------------|------------|---------|
| MEMB.  | FORCE (LBS) | VERT. LOAD | LC1 MAX | MEMB. | FORCE (LBS) | VERT. LOAD | LC1 MAX |
| FR-TO  |             | FROM       | TO      | FR-TO |             | FROM       | TO      |
| A-B    | 0 / 23      | -84.3      | -84.3   | F-C   | 0 / 526     | 0.12       | (1)     |
| B-H    | -607 / 0    | -84.3      | -84.3   | G-H   | -257 / 263  | 0.00       | (1)     |
| H-C    | -585 / 0    | -84.3      | -84.3   | I-J   | -257 / 263  | 0.00       | (1)     |
| C-J    | -585 / 0    | -84.3      | -84.3   |       |             |            |         |
| J-D    | -607 / 0    | -84.3      | -84.3   |       |             |            |         |
| D-E    | 0 / 23      | -84.3      | -84.3   |       |             |            |         |
| B-G    | 0 / 278     | -28.0      | -28.0   |       |             |            |         |
| G-F    | 0 / 390     | -28.0      | -28.0   |       |             |            |         |
| F-I    | 0 / 390     | -28.0      | -28.0   |       |             |            |         |
| I-D    | 0 / 278     | -28.0      | -28.0   |       |             |            |         |

#### DESIGN CRITERIA

##### SPECIFIED LOADS:

|            |           |     |
|------------|-----------|-----|
| TOP CH.    | LL = 25.6 | PSF |
|            | DL = 3.0  | PSF |
| BOT CH.    | LL = 10.5 | PSF |
|            | DL = 7.0  | PSF |
| TOTAL LOAD | = 46.1    | PSF |

##### SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:  
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014  
- CSA 086-09  
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)=  $L/360$  (0.36")  
CALCULATED VERT. DEFL.(LL)=  $L/999$  (0.08")  
ALLOWABLE DEFL.(TL)=  $L/360$  (0.36")  
CALCULATED VERT. DEFL.(TL)=  $L/999$  (0.11")

CSI: TC=0.32 (C-H:1), BC=0.27 (F-G:1), WB=0.12 (C-F:1), SSI=0.22 (B-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10  
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES  
PLATE GRIP(DRY) SHEAR SECTION  
(PSI) (PLI) (PLI)  
MAX MIN MAX MIN MAX MIN  
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.43 (D) (INPUT = 0.50)  
JSI METAL= 0.16 (D) (INPUT = 1.00)



DWG NO. YAM25681-17  
STRUCTURAL  
COMPONENT ONLY

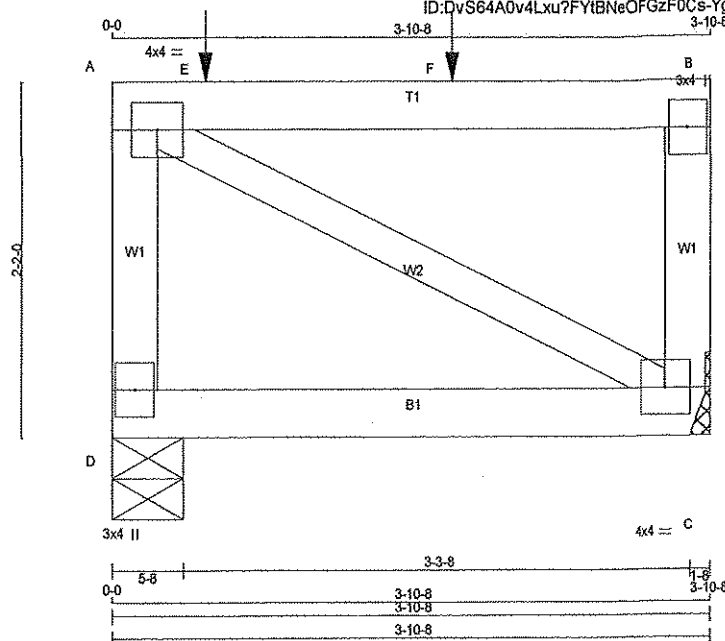


TOTAL WEIGHT =  $2 \times 15 = 31$  lb

1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 201.8 lbs FACTORED DOWN AT 7-4, AND 710.5 lbs FACTORED DOWN AT 2-2-4 ON TOP CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

| JT | LOC.  | LC1  | MAX. | MAX+ | FACE | DIR. | TYPE  |
|----|-------|------|------|------|------|------|-------|
| E  | 7-4   | -202 | -202 | --   | TOP  | VERT | TOTAL |
| E  | 2-2-4 | -711 | -711 | --   | TOP  | VERT | TOTAL |



DWG NO. TAM 256B2-17  
STRUCTURAL  
COMPONENT ONLY



JSI GRIP= 0.74 (J) (INPUT = 0.90 )  
JSI METAL= 0.25 (I) (INPUT = 1.00 )

A circular professional seal for a Licensed Professional Engineer in the Province of Ontario. The seal features the text "LICENSED PROFESSIONAL ENGINEER" around the top arc and "PROVINCE OF ONTARIO" around the bottom arc. In the center, the license number "52417" is written above the name "S. KATSOULAKOS". A stylized quill pen is depicted at the bottom of the seal.

OWG NO. TAMZ568317  
STRUCTURAL  
COMPONENT ONLY


|          |            |          |     |             |       |          |
|----------|------------|----------|-----|-------------|-------|----------|
| JOB NAME | TRUSS NAME | QUANTITY | PLY | JOB DESC.   | 44269 | DRWG NO. |
| 282361   | PB2        | 1        | 1   | TRUSS DESC. |       |          |

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 MiTek Industries, Inc. Wed May 24 09:16:05 2017 Page 1

ID: DvS64A0v4Lxu?FYIBNeOFGzF0Cs-jWZuw7IWacbm1VwHNSXwq?nL0iggevXqjv9KDnzDLXe

Scale = 1:20.7

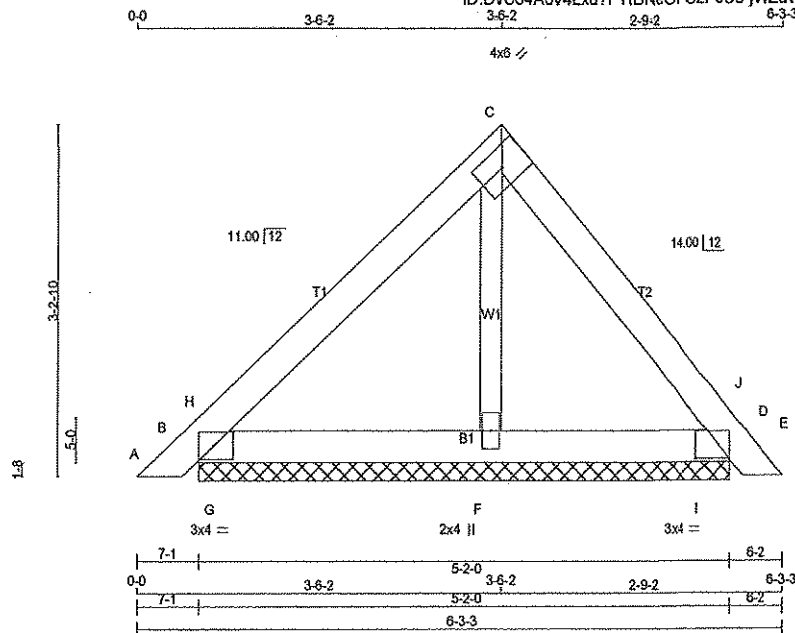

TOTAL WEIGHT = 18 lb

#### LUMBER

N. L. G. A. RULES

| CHORDS                | SIZE | LUMBER | DESCR. |
|-----------------------|------|--------|--------|
| A - C                 | 2x4  | DRY    | No.2   |
| C - E                 | 2x4  | DRY    | No.2   |
| B - D                 | 2x4  | DRY    | No.2   |
| ALL WEBS              | 2x3  | DRY    | No.2   |
| DRY, SEASONED LUMBER. |      |        |        |

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

#### BEARINGS

|    | FACTORED GROSS REACTION | MAXIMUM FACTORED GROSS REACTION | INPUT BRG | REQD BRG |
|----|-------------------------|---------------------------------|-----------|----------|
| JT | VERT                    | HORZ                            | DOWN      | HORZ     |
| B  | 242                     | 0                               | 242       | 0        |
| D  | 217                     | 0                               | 217       | 0        |
| F  | 196                     | 0                               | 196       | 0        |

#### UNFACTORED REACTIONS

| JT | 1ST CASE | MAX MIN | COMPONENT REACTIONS | PERM LIVE | WIND | DEAD | SOIL |
|----|----------|---------|---------------------|-----------|------|------|------|
| B  | 185      | 125/0   | 27/0                | 0/0       | 0/0  | 33/0 | 0/0  |
| D  | 164      | 114/0   | 22/0                | 0/0       | 0/0  | 28/0 | 0/0  |
| F  | 178      | 71/0    | 59/0                | 0/0       | 0/0  | 48/0 | 0/0  |

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

#### BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

#### LOADING

TOTAL LOAD CASES: (4)

| CHORDS | MEMB.  | MAX. FACTORED FORCE (LBS) | FACTORED VERT. LOAD (PLF) | MAX. UNBRACED LENGTH FR-TO | WEBS  | MEMB. | MAX. FACTORED FORCE (LBS) | MAX. UNBRACED LENGTH FR-TO |
|--------|--------|---------------------------|---------------------------|----------------------------|-------|-------|---------------------------|----------------------------|
| A-B    | 0/13   | -84.3                     | -84.3                     | 0.02 (1)                   | 10.00 | F-C   | -54/4                     | 0.01 (1)                   |
| B-H    | -54/9  | -84.3                     | -84.3                     | 0.04 (1)                   | 6.25  | G-H   | -247/40                   | 0.00 (1)                   |
| H-C    | -88/0  | -84.3                     | -84.3                     | 0.09 (1)                   | 6.25  | I-J   | -191/22                   | 0.00 (1)                   |
| C-J    | -102/0 | -84.3                     | -84.3                     | 0.05 (1)                   | 6.25  |       |                           |                            |
| J-D    | -44/0  | -84.3                     | -84.3                     | 0.03 (1)                   | 6.25  |       |                           |                            |
| D-E    | 0/11   | -84.3                     | -84.3                     | 0.01 (1)                   | 10.00 |       |                           |                            |
| B-G    | 0/59   | -28.0                     | -28.0                     | 0.08 (1)                   | 10.00 |       |                           |                            |
| G-F    | 0/59   | -28.0                     | -28.0                     | 0.08 (1)                   | 10.00 |       |                           |                            |
| F-I    | 0/61   | -28.0                     | -28.0                     | 0.07 (1)                   | 10.00 |       |                           |                            |
| I-D    | 0/61   | -28.0                     | -28.0                     | 0.05 (1)                   | 10.00 |       |                           |                            |

#### DESIGN CRITERIA

SPECIFIED LOADS:  
TOP CH. LL = 25.6 PSF  
DL = 3.0 PSF  
BOT CH. LL = 10.5 PSF  
DL = 7.0 PSF  
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:  
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014  
- CSA 088-09  
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.09 (C-H:1), BC=0.08 (B-G:1), WB=0.01 (C-F:1), SSI=0.20 (B-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10  
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES  
PLATE GRIP(DRY) SHEAR SECTION  
(PSI) (PLI) (PLI)  
MAX MIN MAX MIN MAX MIN  
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.25 (D) (INPUT = 0.90)  
JSI METAL= 0.05 (D) (INPUT = 1.00)



DWG NO. YAM25684-17  
STRUCTURAL  
COMPONENT ONLY

# HUS/LJS – Double Shear Joist Hangers



All hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

**MATERIAL:** See table

**FINISH:** G90 galvanized

**DESIGN:**


- Factored resistances are in accordance with CSA 086-14
- Uplift resistances have been increased 15%  
No further increase is permitted
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

**INSTALLATION:**


- Use all specified fasteners
- Nails: 16d = 0.162" dia. x 3½" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

**OPTIONS:**


- See current catalogue for options




LJS26DS

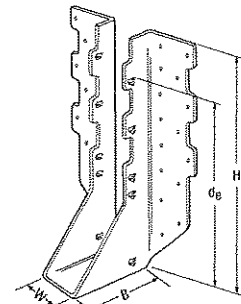


HUS210  
(HUS26, HUS28, similar)



Typical LJS26DS  
Installation




Typical HUS  
Installation

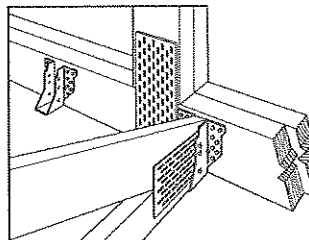

Typical HUS Installation  
(Truss Designer to provide fastener  
quantity for connecting multiple  
members together)


| Model<br>No. | Ga | Dimensions (in)                 |                                | Fasteners                     |                                 |        |        | Factored Resistance (lbs) |                        |                        |                        |
|--------------|----|---------------------------------|--------------------------------|-------------------------------|---------------------------------|--------|--------|---------------------------|------------------------|------------------------|------------------------|
|              |    |                                 |                                |                               |                                 |        |        | D.Fir-L                   |                        | S-P-F                  |                        |
|              |    | W                               | H                              | B                             | d <sub>g</sub> <sup>1</sup>     | Face   | Joist  | Uplift                    | Normal                 | Uplift                 | Normal                 |
|              |    |                                 |                                |                               |                                 |        |        | (K <sub>o</sub> =1.15)    | (K <sub>o</sub> =1.00) | (K <sub>o</sub> =1.15) | (K <sub>o</sub> =1.00) |
| LJS26DS      | 18 | 1 <sup>9</sup> / <sub>16</sub>  | 5                              | 3 <sup>1</sup> / <sub>2</sub> | 4 <sup>5</sup> / <sub>8</sub>   | 16-16d | 6-16d  | 2055                      | 4265                   | 1460                   | 4115                   |
| HUS26        | 16 | 1 <sup>5</sup> / <sub>8</sub>   | 5 <sup>5</sup> / <sub>8</sub>  | 3                             | 3 <sup>15</sup> / <sub>16</sub> | 14-16d | 6-16d  | 2705                      | 4940                   | 2065                   | 3875                   |
| HUS28        | 16 | 1 <sup>5</sup> / <sub>8</sub>   | 7 <sup>3</sup> / <sub>32</sub> | 3                             | 6 <sup>3</sup> / <sub>32</sub>  | 22-16d | 8-16d  | 3605                      | 5365                   | 2675                   | 4345                   |
| HUS210       | 16 | 1 <sup>5</sup> / <sub>8</sub>   | 9 <sup>3</sup> / <sub>32</sub> | 3                             | 7 <sup>31</sup> / <sub>32</sub> | 30-16d | 10-16d | 4505                      | 5795                   | 4010                   | 4740                   |
| HUS1.81/10   | 16 | 1 <sup>13</sup> / <sub>16</sub> | 9                              | 3                             | 8                               | 30-16d | 10-16d | 4505                      | 6450                   | 4010                   | 5200                   |

1. d<sub>g</sub> is the distance from the seat of the hanger to the highest joist nail.




Dome Double  
Shear Nailing  
prevents tabs  
breaking off  
(available on  
some models).


U.S. Patent  
5,603,580



Double  
Shear  
Nailing  
Side  
View. Do  
not bend  
tab back.



Double  
Shear  
Nailing  
Top View.

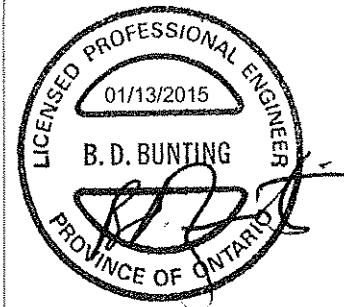

LIMIT  
STATES  
DESIGN

This technical bulletin is effective until December 31, 2016, and reflects information available as of January 1, 2015. This information is updated periodically and should not be relied upon after December 31, 2016; contact Simpson Strong-Tie for current information and limited warranty or see [www.strongtie.com](http://www.strongtie.com).


© 2015 Simpson Strong-Tie Company Inc.

T-SPECUS15 1/15 exp. 12/16

800-999-5099  
[www.strongtie.com](http://www.strongtie.com)



# LUS – Double Shear Joist Hangers



All LUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections.

**MATERIAL:** 18 gauge

**FINISH:** G90 galvanized

**DESIGN:**

- Factored resistances are in accordance with CSA O86-14
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.



**INSTALLATION:**

- Use all specified fasteners
- Nails: 16d = 0.162" dia. x 3½" long common wire, 10d = 0.148" x 3" long common wire.
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

**OPTIONS:**


- These hangers cannot be modified.

Typical LUS Installation

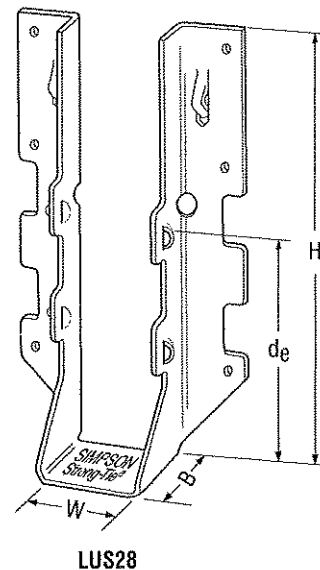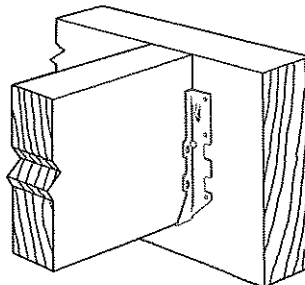


| Model No. | Ga | Dimensions (in) |    |    |                 | Fasteners |       | Factored Resistance (lbs)        |                                  |                                  |                                  |
|-----------|----|-----------------|----|----|-----------------|-----------|-------|----------------------------------|----------------------------------|----------------------------------|----------------------------------|
|           |    | W               | H  | B  | dg <sup>1</sup> | Face      | Joist | D.Fir-L                          |                                  | S-P-F                            |                                  |
|           |    |                 |    |    |                 |           |       | Uplift<br>(K <sub>D</sub> =1.15) | Normal<br>(K <sub>D</sub> =1.00) | Uplift<br>(K <sub>D</sub> =1.15) | Normal<br>(K <sub>D</sub> =1.00) |
| LUS24     | 18 | 1⅞              | 3⅞ | 1¾ | 1⅝              | 4-10d     | 2-10d | 710                              | 1630                             | 645                              | 1155                             |
| LUS24-2   | 18 | 3⅞              | 3⅞ | 2  | 1⅝              | 4-16d     | 2-16d | 835                              | 2020                             | 590                              | 1435                             |
| LUS26     | 18 | 1⅞              | 4⅞ | 1¾ | 3⅞              | 4-10d     | 4-10d | 1420                             | 2170                             | 1290                             | 1630                             |
| LUS26-2   | 18 | 3⅞              | 4⅞ | 2  | 4               | 4-16d     | 4-16d | 1720                             | 2595                             | 1545                             | 1920                             |
| LUS26-3   | 18 | 4⅞              | 4⅞ | 2  | 3¼              | 4-16d     | 4-16d | 1720                             | 2595                             | 1545                             | 2340                             |
| LUS28     | 18 | 1⅞              | 6⅞ | 1¾ | 3¾              | 6-10d     | 4-10d | 1420                             | 2520                             | 1290                             | 1790                             |
| LUS28-2   | 18 | 3⅞              | 7  | 2  | 4               | 6-16d     | 4-16d | 1720                             | 3325                             | 1545                             | 2575                             |
| LUS28-3   | 18 | 4⅞              | 6¼ | 2  | 3¼              | 6-16d     | 4-16d | 1720                             | 3325                             | 1545                             | 2375                             |
| LUS210    | 18 | 1⅞              | 7⅝ | 1¾ | 3⅞              | 8-10d     | 4-10d | 1420                             | 2785                             | 1290                             | 2210                             |
| LUS210-2  | 18 | 3⅞              | 9  | 2  | 6               | 8-16d     | 6-16d | 2580                             | 4500                             | 2320                             | 3195                             |
| LUS210-3  | 18 | 4⅞              | 8⅝ | 2  | 5¼              | 8-16d     | 6-16d | 2580                             | 3345                             | 2320                             | 2375                             |

1. dg is the distance from the seat of the hanger to the highest joist nail.




Dome Double Shear Nailing prevents tabs breaking off (available on some models).

U.S. Patent 5,603,580



Double Shear Nailing Top View.

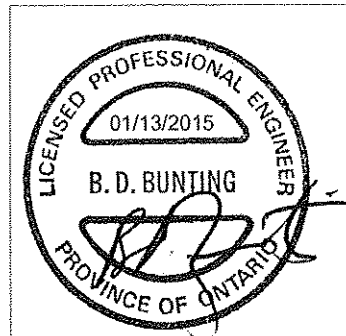

LIMIT STATES DESIGN

This technical bulletin is effective until December 31, 2016, and reflects information available as of January 1, 2015. This information is updated periodically and should not be relied upon after December 31, 2016; contact Simpson Strong-Tie for current information and limited warranty or see [www.strongtie.com](http://www.strongtie.com).

© 2015 Simpson Strong-Tie Company Inc.

T-SPECUS15 1/15 exp. 12/16


800-999-5099  
[www.strongtie.com](http://www.strongtie.com)

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

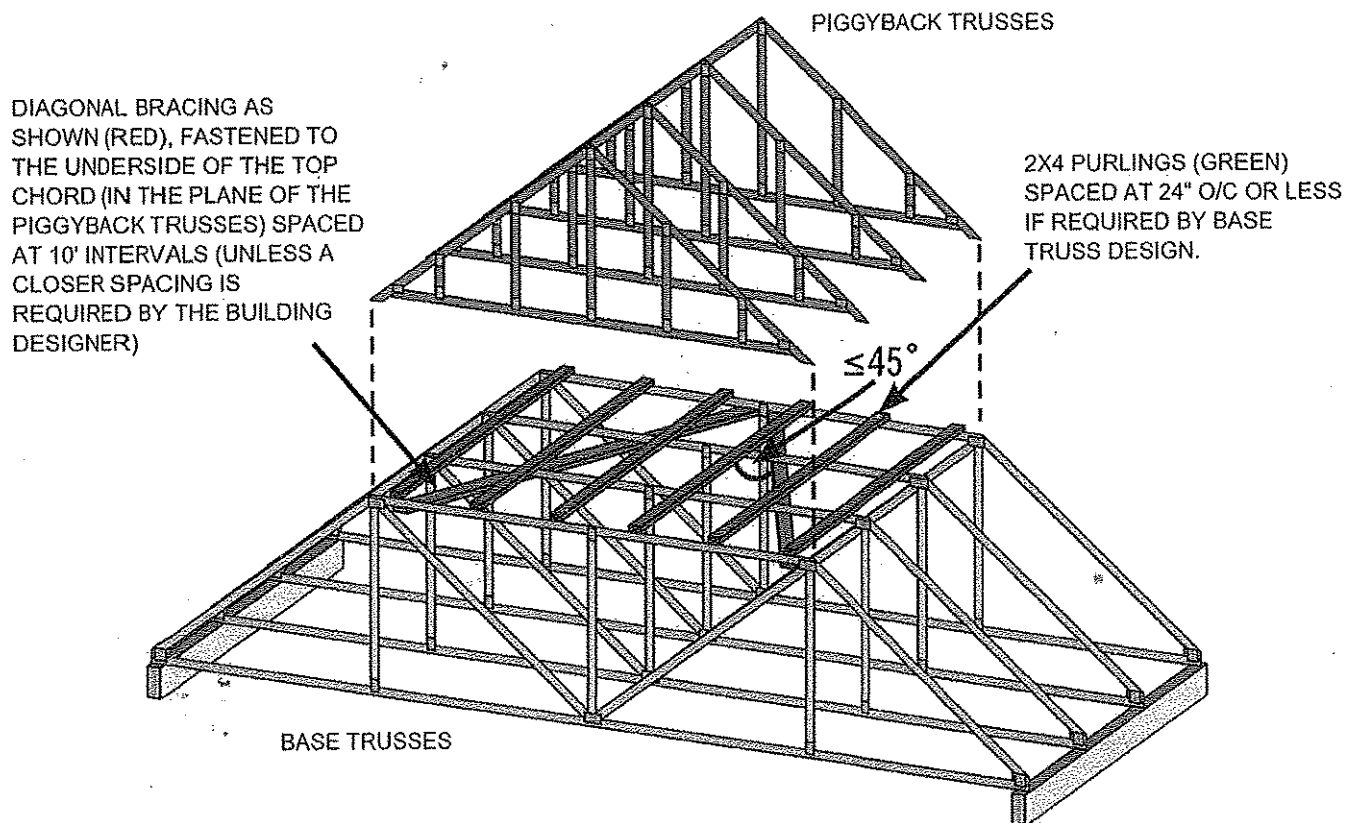

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.


SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.

# MICRO CITY ENGINEERING SERVICES INC.

TEL: (519) 287 - 2242

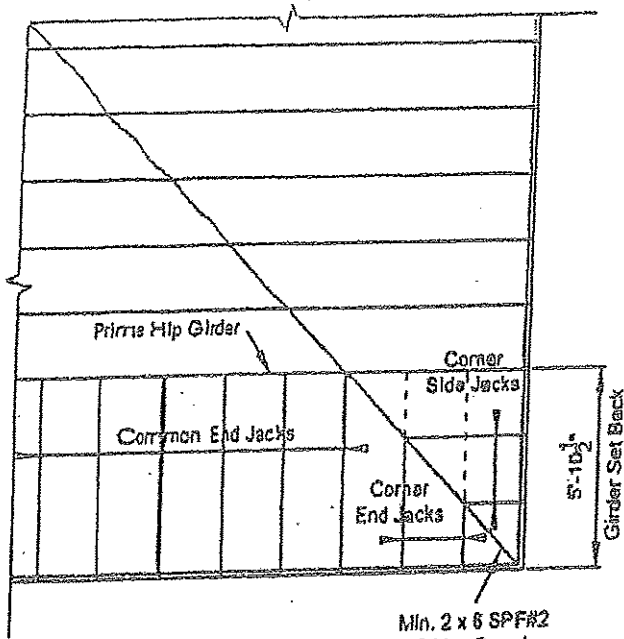

45° Hip End

## LUMBER SPECIFICATION

TOP CHORD : 2 x 4 SPF#2

BOTTOM CHORD : 2 x 4 SPF#2

WEBS : 2 x 3 SPF#2

UNLESS OTHERWISE SHOWN

## DESIGN LOAD:

TOP CHORD LIVE LOAD : 34.8 P.S.F.



TOP CHORD DEAD LOAD : 3.0 P.S.F.

BOTTOM CHORD LIVE LOAD : 0.0 P.S.F.


BOTTOM CHORD DEAD LOAD : 7.0 P.S.F.

TOTAL LOAD : 44.8 P.S.F.


DWG NO TAM 3495.14  
STRUCTURAL  
COMPONENT ONLY

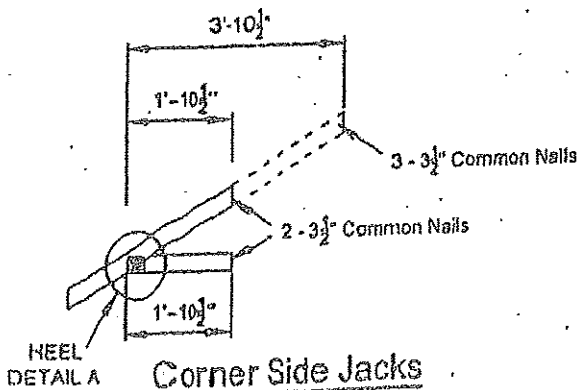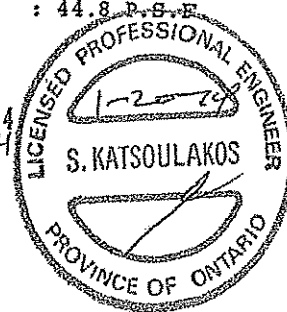


Corner Side Jacks

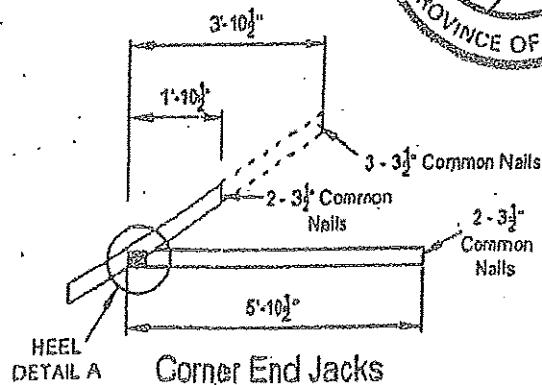

Corner End Jacks

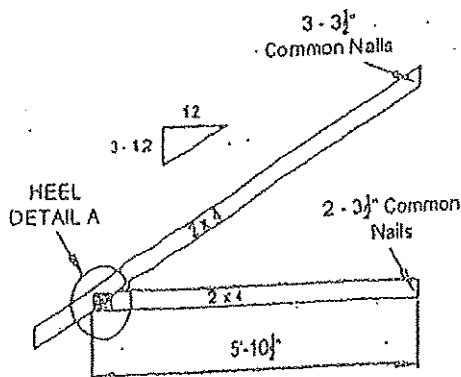

Common End Jacks

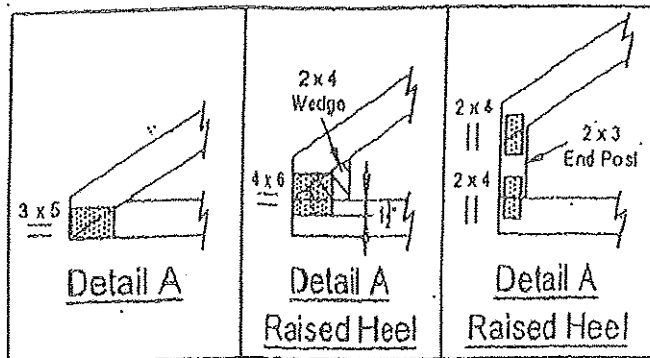

NOTE: DESIGN CONFORMS TO PART 9, O.B.C. 2012 (LIMIT STATES DESIGN)  
(TO BE INCLUDED AND USED AS PART OF A FULL TRUSS ENGINEERING PACKAGE)

# MICRO CITY ENGINEERING SERVICES INC.

TEL: (519) 287 - 2242

R.R. #1, P.O. BOX 61, GLENCOE, ONTARIO, N0L 1M0


## LUMBER SPECIFICATION

TOP CHORD : 2 x 4 SPF#2  
BOTTOM CHORD : 2 x 4 SPF#2  
WEBS : 2 x 3 SPF#2  
UNLESS OTHERWISE SHOWN

## DESIGN LOAD:






TOP CHORD LIVE LOAD : 34.8 P.S.F.  
TOP CHORD DEAD LOAD : 3.0 P.S.F.  
BOTTOM CHORD LIVE LOAD : 0.0 P.S.F.  
BOTTOM CHORD DEAD LOAD : 7.0 P.S.F.

TOTAL LOAD : 44.8 P.S.F.

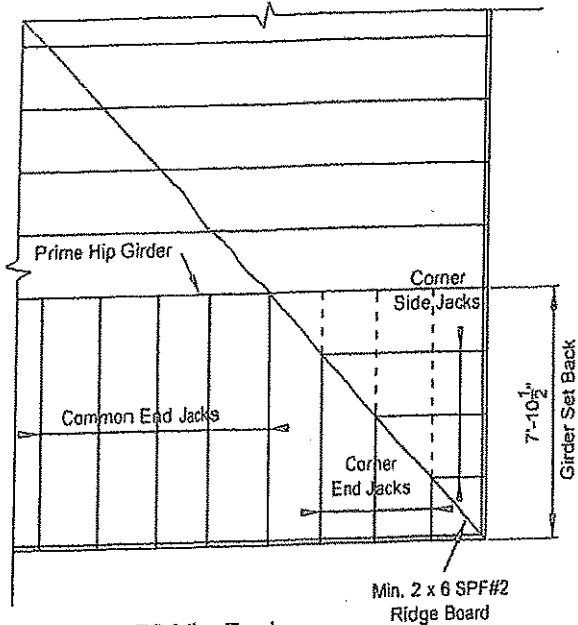

45° Hip End



DWG NO TAM 3503.14  
STRUCTURAL  
COMPONENT ONLY

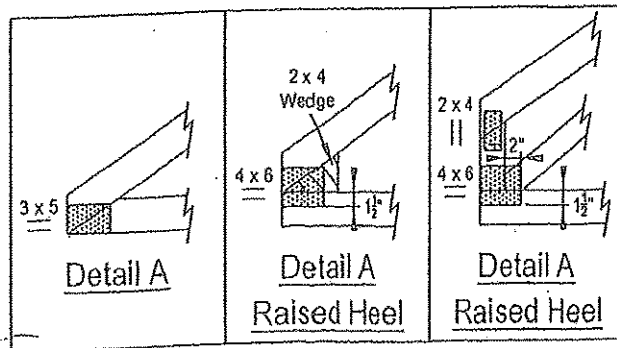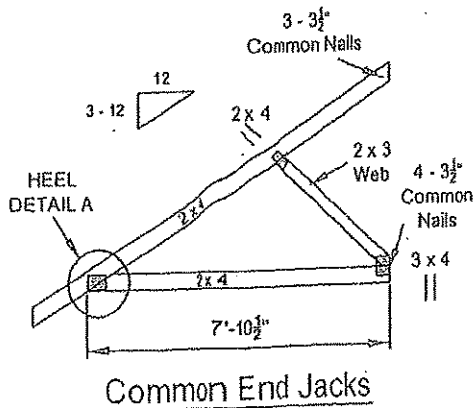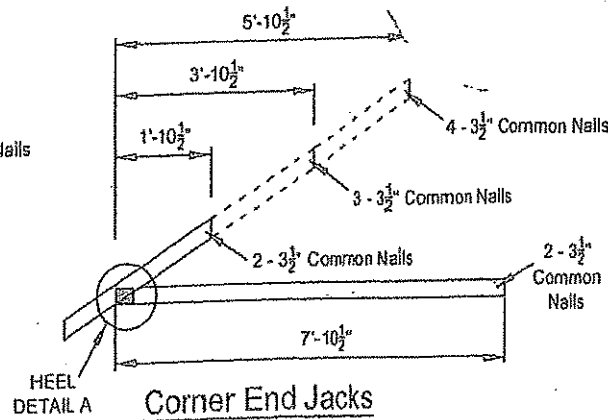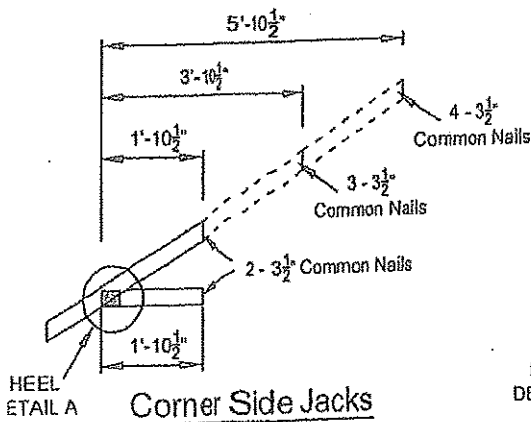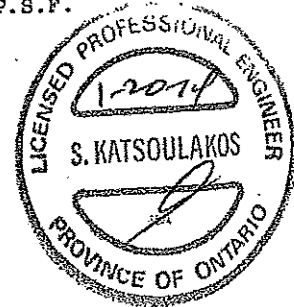

NOTE: DESIGN CONFORMS TO PART 9, O.B.C. 2012 (LIMIT STATES DESIGN)  
(TO BE INCLUDED AND USED AS PART OF A FULL TRUSS ENGINEERING PACKAGE)

## Symbols

### PLATE LOCATION AND ORIENTATION

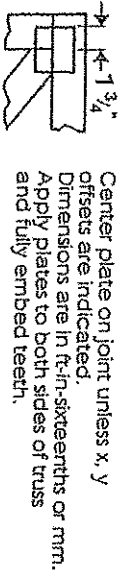

— This symbol indicates the required direction of slots in connector plates.

\* Plate location details available in Mitek software or upon request.

### PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

### LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use L, I or Eliminator bracing if indicated.

### BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.

Industry Standards:  
TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses  
DSB-89: Design Standard for Bracing.  
BCSI: Building Component Safety Information.  
Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

## Numbering System

6-4-8 dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

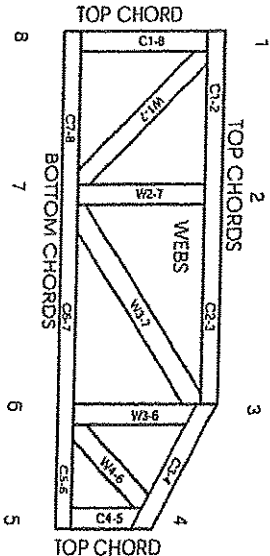

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.


### PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 Mitek® All Rights Reserved

Mitek Engineering Reference Sheet MII-7473C rev. 10-08



## General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral bracing members may require bracing, or alternative I, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and ware at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or pulins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

# MICRO CITY ENGINEERING SERVICES INC.

TEL: (519) 287 - 2242

R.R. #1, P.O. BOX 61, GLENCOE, ONTARIO, NOL 1M0

## CONVENTIONAL VALLEY FRAMING DETAIL

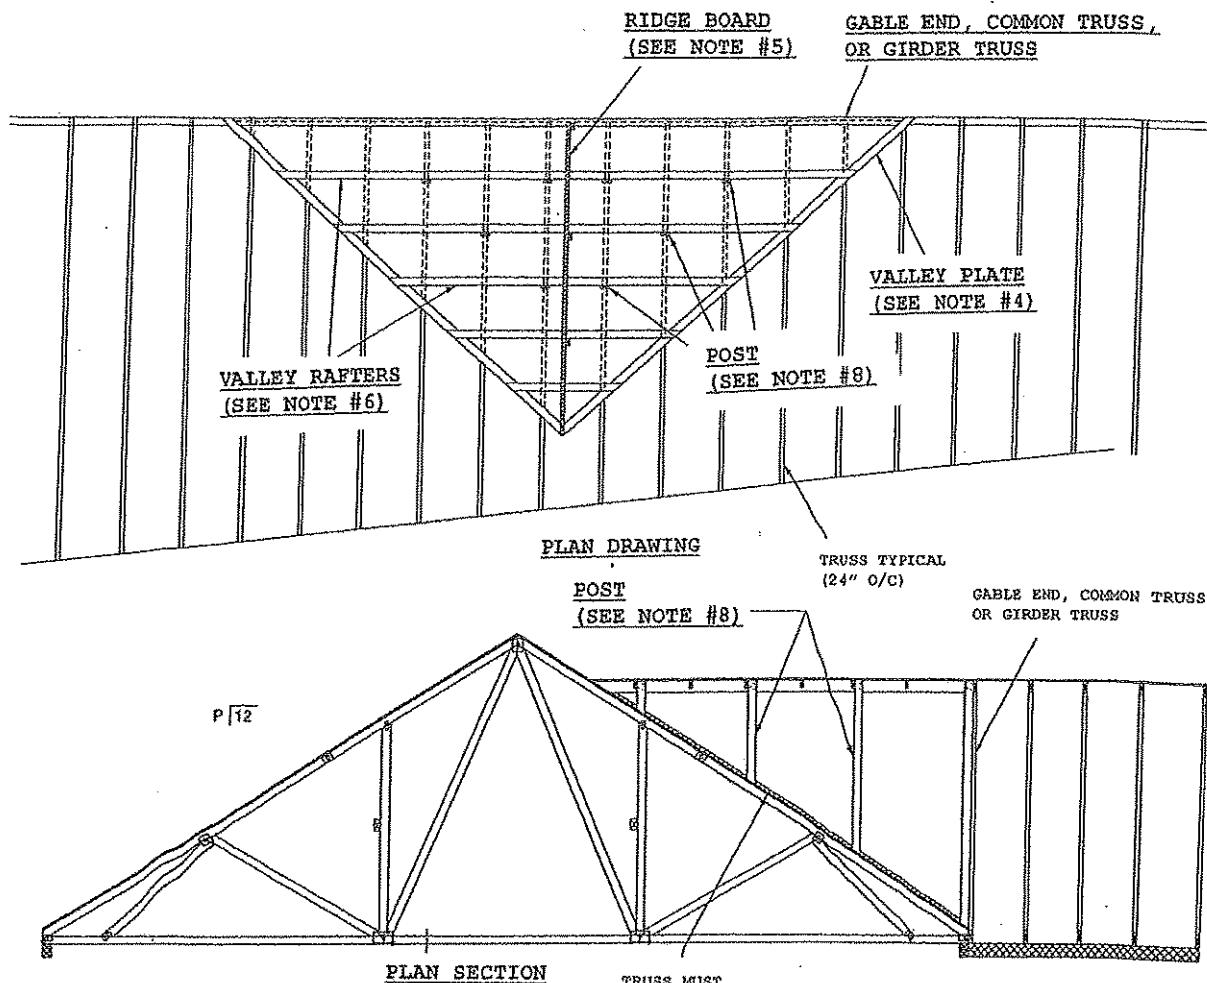

### GENERAL SPECIFICATIONS:

- (1) WITH THE BASE TRUSSES ERECTED (INSTALLED), APPLY SHEATHING TOP CHORD OF SUPPORTING (BASE) TRUSSES.
- (2) BRACE BOTTOM CHORD AND WEB MEMBERS AS PER PRE-ENGINEERED TRUSS DESIGNS.
- (3) DEFINE VALLEY RIDGE BY RUNNING A LEVEL STRING FROM THE INTERSECTING RIDGE OF THE (a) GABLE END, (b) GIRDER TRUSS OR (c) COMMON TRUSS TO THE ROOF SHEATHING.
- (4) INSTALL 2 X 6 VALLEY PLATES ON FLAT. FASTEN TO EACH SUPPORTING TRUSS WITH (2) 16d (3.5" X 0.131") NAILS.
- (5) SET A 2 X 6 #2 RIDGE BOARD (MAX. 10'-0" RIDGE) OR 2 X 8 #2 SPF RIDGE BOARD (MAX. 20'-0" RIDGE). SUPPORT RIDGE BOARD WITH 2 X 4 POSTS SPACED 48" O/C. BEVEL BOTTOM OF POST TO SET EVENLY ON THE SHEATHING. FASTEN POST TO RIDGE WITH (4) 10d (3" X 0.131") NAILS. FASTEN POST TO ROOF SHEATHING WITH (3) 10d (3" X 0.131") TOE-NAILS.
- (6) FRAME VALLEY RAFTERS FROM VALLEY PLATE TO RIDGE BOARD. MAXIMUM RAFTER SPACING IS 24" O/C. FASTEN VALLEY RAFTER TO RIDGE BEAM WITH (3) 16d (3.5" X 0.131") TOE-NAILS. FASTEN VALLEY RAFTER TO VALLEY PLATE WITH (3) 16d (3.5" X 0.131") TOE-NAILS.
- (7) SUPPORT THE VALLEY RAFTERS WITH 2 X 4 POSTS AT 48" O/C (OR LESS) ALONG EACH RAFTER. INSTALL POSTS IN A STAGGERED PATTERN AS SHOWN ON PLAN DRAWING. ALIGN POSTS WITH TRUSSES BELOW. FASTEN VALLEY RAFTER TO POST WITH (4) 10d (3" X 0.131") NAILS. FASTEN POST THROUGH SHEATHING TO SUPPORTING TRUSSES WITH (2) 16d (3.5" X 0.131") NAILS.
- (8) POSTS SHALL BE 2 X 4 #2 SPF OR BETTER. POSTS EXCEEDING 75" IN HEIGHT SHALL BE INCREASED TO 4 X 4 #2 SPF, OR BETTER, OR BE PRE-ASSEMBLED TWO (2) PLY 2 X 4 #2 SPF OR BETTER FASTENED TOGETHER WITH 2 ROWS OF 10d (3" X 0.131") NAILS AT 6" O/C.
- (9) MAINTAIN A MINIMUM 3/4" LUMBER EDGE DISTANCE WHEN NAILING. NAIL SPACING SHOULD APPROXIMATE A MINIMUM 1-3/4" O/C OR MORE UNLESS NOTED OTHERWISE. ALL CONSTRUCTION TO CONFORM TO ONTARIO BUILDING CODE (CURRENT ADDITION) AT ALL TIMES.

### NOTES:

- (10) 48" O/C (MAXIMUM POST SPACING).
- (11) ROOF LIVE LOAD = 34.8 PSF (MAX.)
- (12) ROOF DEAD LOAD = 10.0 PSF (MAX.)
- (13) PART 9 APPLICATION ONLY (ONTARIO BUILDING CODE)
- (14) PART 4 APPLICATION ONLY (ONTARIO BUILDING CODE) WITH APPROVED REVIEW BY LICENSED PROFESSIONAL ENGINEER.
- (15) BASE TRUSS SPACING (24" O/C MAX.)
- (16) ALL PRE-ENGINEERED BASE TRUSS COMPONENTS TO BE SEALED BY LICENSED PROFESSIONAL ENGINEER AND THIS DETAIL TO BE VERIFIED AND APPROVED BY SAME WHEN RIDGE BOARD LENGTH EXCEEDS 12'-0".
- (17) ALL BASE TRUSSES: P = 4 (3/12) - MINIMUM.
- (18) ALL VALLEY RAFTERS: P = 4 (4/12) - MINIMUM.



DWG NO TAM 6305.14  
STRUCTURAL  
COMPONENT ONLY


Micro City Engineering Services Inc.  
(BCIN: 26064; FIRM BCIN: 29991)

RR #1, Po Box 61

Glencoe, Ontario

NOL 1M0

(519) 287 - 2242; Fax: (519) 287 - 5750 (Call)

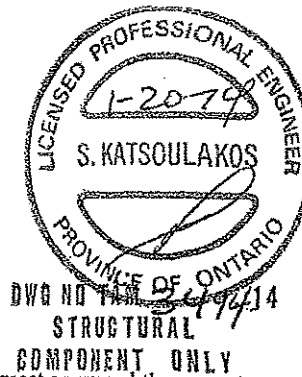

### Responsibilities:

Micro City Engineering Services is responsible for the design of trusses as individual components.

It is the responsibilities of others to ascertain that the design loads utilized on this (these) drawing(s) meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdiction over such decisions.

All dimensions are to be verified by the owner, contractor, architect, or other authority having input over such decisions prior to truss component manufacture. At no time shall Micro City Engineering Services Inc. or its employees be responsible for dimension errors.

Micro City Engineering Services Inc. bears no responsibility for the erection of any truss components. Persons erecting truss components are cautioned to seek professional advice regarding temporary and permanent bracing systems and to be totally familiar with all aspects of truss erection prior to proceeding on any truss component erection job. Any bracing shown on Micro City Engineering Services Inc. or Tamarack Roof Trusses Inc. sealed or unsealed truss component drawings is specified for the single truss component in question and is identified as an integral part of the design for that particular truss component but is not meant to represent the only required bracing for that particular truss component when installed as a component in a series of truss components in a roof truss system.

It is the truss manufacturer's responsibility to ensure that trusses are manufactured in accordance with Micro City Engineering Services Inc. specifications outlined below:

### SPECIFICATIONS:

Truss components sealed by Micro City Engineering Services Inc. must conform to the relevant sections of the current Building Code of Ontario and Canada (Part 4 or Part 9) or the current Farm Building Code of Canada in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the Truss Plate Institute of Canada (TPIC). All unit lumber and nailing stresses identified on truss component design drawings and/or used in the design of individual truss components shall conform to the current CSA Wood Design standard identified in the current Building Code and TPIC Design Standards.

The lumber used to manufacture any truss component is to conform to the specified size and grade identified on the truss drawing.

The lumber used in the manufacture of any truss component is not to exceed 19% during its service use unless specifically noted on the truss drawing.

The lumber used in the manufacture of any truss component is not to be treated with any chemicals during its service life unless specifically noted on the truss drawing.

Connector plates shall be applied to both faces of the truss component at each joint and shall be positioned exactly as specified.

The top chord of any truss component is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the sealed truss component drawing but not exceeding 24" o/c (Part 9 design) and not exceeding 48" o/c (Part 4 or Agricultural design).

When a truss component is to be installed with no rigid ceiling attached directly to the bottom chord, then the bottom chord is to be laterally braced at intervals not exceeding 3m (or 10'-0").

**All sealed or unsealed truss component drawings provided by Micro City Engineering Services Inc. Or Tamarack Roof Trusses Inc. should be read in conjunction with the following:**

Warning-Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473C rev 10-'08 BEFORE USE. Design valid for use only with Mitek connectors. This design is based only upon parameters shown, and is for individual building component. Applicability of design parameters and proper incorporation of component is the responsibility of the building designer - not the truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection, and bracing, consult TPIC Appendix G - Minimum Quality Manufacturing Criteria available from [www.tpinc.ca](http://www.tpinc.ca) and BCSI Building Component Safety Information available from the Truss Plate Institute, 781 N. Lee Street, Suite 312, Alexandria, VA, 22314.