

ENGINEERING NOTE PAGE (ENP-1)
PLEASE READ PRIOR TO INSTALLATION

NE0518-221 GREEN YORK HOMES - GRANELLI HOME COPR - AMELIA 1 ELE 1
--

RESPONSIBILITIES

THIS DESIGN IS FOR AN INDIVIDUAL BUILDING COMPONENT AND HAS BEEN BASED ON INFORMATION PROVIDED BY THE DESIGN OFFICE OF KOTT LUMBER. THE UNDERSIGNED ENGINEER DISCLAIMS ANY RESPONSIBILITY FOR DAMAGES AS A RESULT OF FAULTY OR INCORRECT INFORMATION, SPECIFICATION AND/OR DESIGNS FURNISHED TO THE ENGINEER. THE UNDERSIGNED ENGINEER IS ONLY RESPONSIBLE FOR THE STRUCTURAL INTEGRITY OF THIS BUILDING COMPONENT FOR THE CONDITIONS AND LOADS SHOWN ON THIS DRAWING. THE STRUCTURAL INTEGRITY OF THE BUILDING AND THE VERIFICATION OF THE DIMENSIONS AND THE DESIGN LOADS USED ARE THE RESPONSIBILITY OF THE BUILDING DESIGNER.

TRUSSES ARE DESIGNED IN CONFORMANCE WITH THE RELEVANT SECTIONS OF THE NATIONAL BUILDING CODE OF CANADA OR THE CANADIAN CODE FOR FARM BUILDINGS, WHICHEVER APPLIES TO THE BUILDING TYPE INDICATED ON THE DRAWING

IT IS THE RESPONSIBILITY OF KOTT LUMBER TO ENSURE THAT TRUSSES ARE MANUFACTURED IN CONFORMANCE WITH THESE DESIGNS AND WITH THE SPECIFICATIONS OUTLINED BELOW. THE UNDERSIGNED ENGINEER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

USE AND OCCUPANCY

- The building is of the type indicated on the drawing

LOADING

- The truss loading intensity and distribution as well as load transfer mechanism is that indicated on the drawing
- No buildings, trees, parapets or other projections higher than the roof for which the trusses are used are located within a distance less than ten (10) times the difference in height, or five metres (16 ft) whichever is greater, unless the drawing indicates that the snow drifting has been taken into account

HANDLING, INSTALLATION AND BRACING

- The trusses must be handled and installed by a qualified professional as per the supplied document titled *Information for Truss Installers* and the BCSI-B1 and BCSI-B3 Summary Sheets
- The compression chords are laterally braced by continuous rigid diaphragm sheathing or as specified on the drawing
- Temporary and permanent bracing must be installed as indicated on the truss drawing and according to the BCSI-B1 and BCSI-B3 Summary Sheets. Bracing for the lateral stability of the truss is to be provided by the building designer
- **It is recommended that a Professional Engineer's advice be obtained for the bracing of trusses spanning more than 12.37m (40'-7")**

SUPPORTS


- The trusses are to be supported at the bearing points indicated and anchored to the supports where considered necessary by the designer of the overall structure
- Bearing sizes shown are the minimum required to prevent crushing of the truss members and do not necessarily take into account stability of the overall building structure
- Elevation of bearings must be carefully checked and shimmed to alignment for solid bearings
- Adequate wood truss bearing is the responsibility of the building designer.


DIMENSIONS

- Geometry of the truss and dimensions indicated on the drawing are identical to those of the installed truss.

Layout based on plans provided by
Jardin Design Group Inc.
Revision #2 dated May 22, 2018

THIS CERTIFICATION IS FOR THE ENGINEERING REVIEW OF STRUCTURAL COMPONENTS SHOWN ON THIS DRAWING AND IS LIMITED TO THE COMPONENTS SUPPLIED BY KOTT LUMBER FOR THE LOADS AND CONDITIONS SHOWN ON THE CALCULATION PAGE OF EACH COMPONENT. THE PLACEMENT OF THESE COMPONENTS ON THIS LAYOUT IS SHOWN FOR REFERENCE ONLY. ROOF TRUSSES MUST BE INSTALLED ACCORDING TO MANUFACTURER'S GUIDELINES AT 24" C/C UNLESS NOTED OTHERWISE. CONVENTIONAL FRAMING SHOWN ON THE LAYOUT MUST BE DESIGNED AND APPROVED BY THE PROJECT ENGINEER. TEMPORARY AND PERMANENT BRACINGS OF THE ROOF AND BUILDING ARE THE RESPONSIBILITY OF THE PROJECT ENGINEER AND TO CONFORM TO BCSI GUIDELINES.

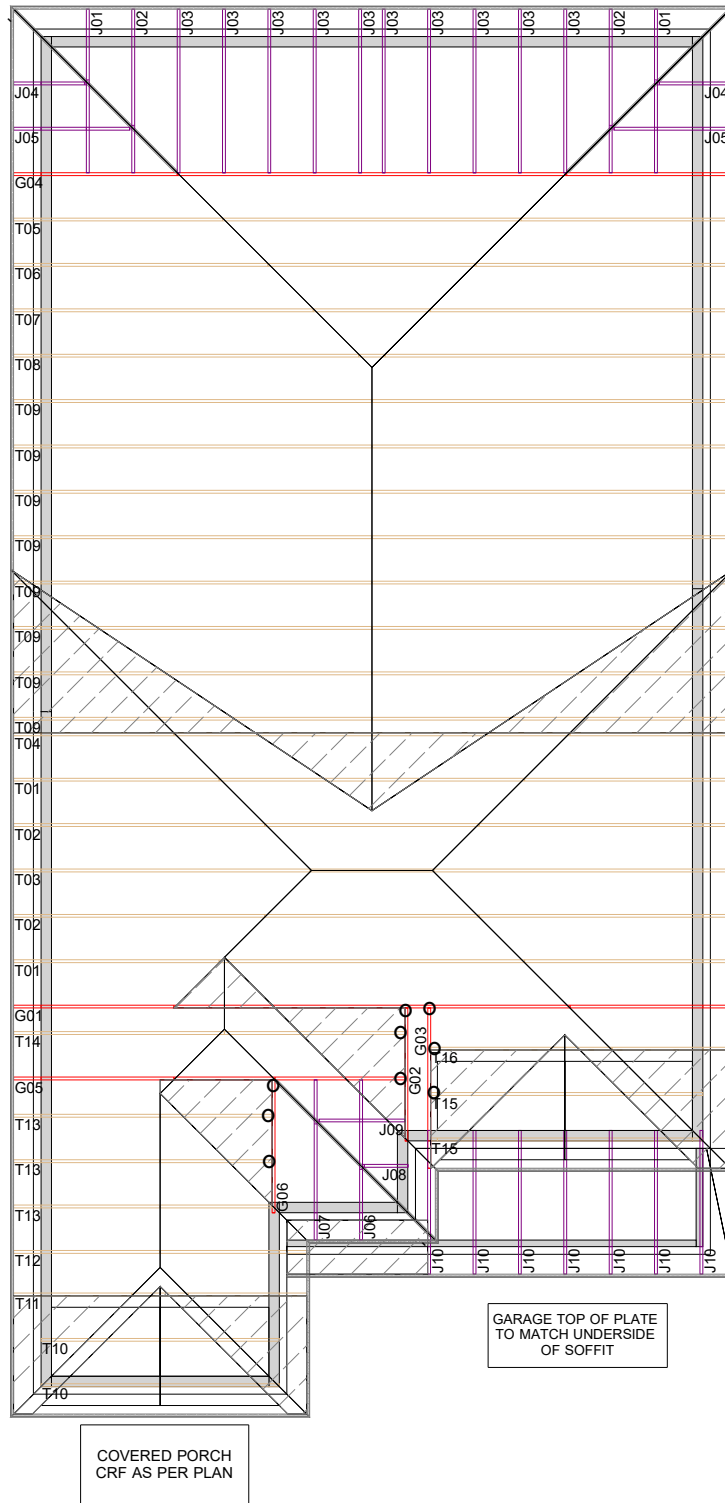

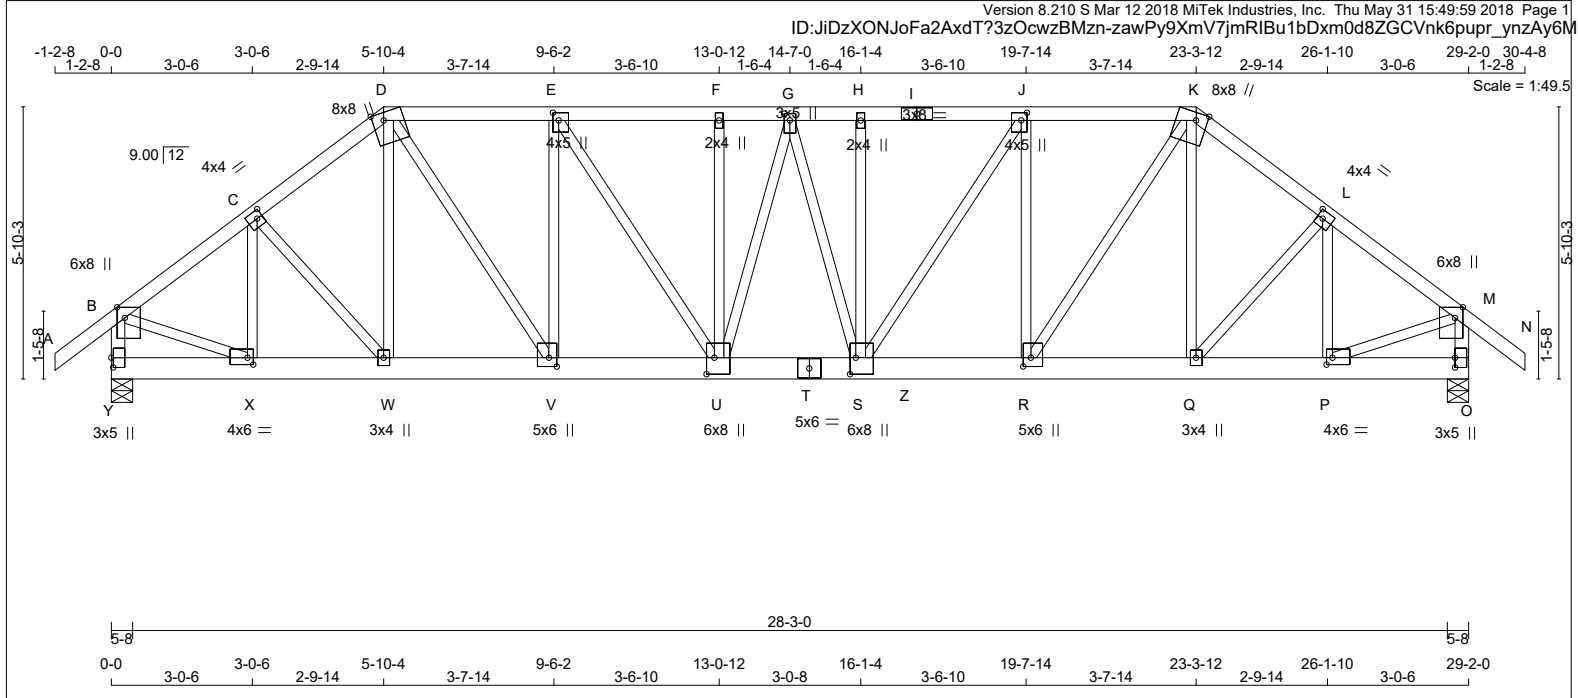

TOTAL WEIGHT = 164 LB										[M]
LUMBER										
N. L. G. A. RULES										
CHORDS SIZE LUMBER DESCR.										
A - D	2x4	DRY	No.2	SPF						
D - I	2x4	DRY	No.2	SPF						
I - K	2x4	DRY	No.2	SPF						
K - N	2x4	DRY	No.2	SPF						
Y - B	2x4	DRY	No.2	SPF						
O - M	2x4	DRY	No.2	SPF						
Y - T	2x6	DRY	2100F 1.8E	SPF						
T - O	2x6	DRY	2100F 1.8E	SPF						
ALL WEBS 2x3 DRY No.2 SPF										
EXCEPT										
DRY: SEASONED LUMBER.										
PLATES (table is in inches)										
JT	TYPE	PLATES	W	LEN	Y	X				
B	TMVW+p	MT20	6.0	8.0	2.75	2.00				
C	TMWW-t	MT20	4.0	4.0	2.00	1.50				
D	TTWW+m	MT20	8.0	8.0	Edge	3.00				
E	TMWW+t	MT20	4.0	5.0	2.00	1.50				
F	TMW+w	MT20	2.0	4.0						
G	TMWW+t	MT20	3.0	5.0	1.75	1.50				
H	TMW+w	MT20	2.0	4.0						
I	TS-t	MT20	3.0	8.0						
J	TMWW+t	MT20	4.0	5.0	2.00	1.50				
K	TTWW+m	MT20	8.0	8.0	Edge	3.00				
L	TMWW-t	MT20	4.0	4.0	2.00	1.50				
M	TMVW+p	MT20	6.0	8.0	2.75	2.00				
O	BMV1+p	MT20	3.0	5.0	2.50					
P	BMWW-t	MT20	4.0	6.0	1.75	1.50				
Q	BMWW+t	MT20	3.0	4.0						
R	BMWW+t	MT20	5.0	6.0	2.25	2.00				
S	BMWWW+t	MT20	6.0	8.0	4.25	1.50				
T	BS-t	MT20	5.0	6.0						
U	BMWWW+t	MT20	6.0	8.0	4.25	2.00				
V	BMWW+t	MT20	5.0	6.0	2.25	2.00				
W	BMWW+t	MT20	3.0	4.0						
X	BMWW-t	MT20	4.0	6.0	1.75	1.50				
Y	BMV1+p	MT20	3.0	5.0	2.50	0.50				
Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.										
										
READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.										
DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										
BEARINGS										
FACTORED GROSS REACTION MAXIMUM FACTORED GROSS REACTION INPUT BRG REQRD BRG										
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX			
Y	2651	0	2651	0	0	5-8	5-8			
O	2994	0	2994	0	0	5-8	5-8			
UNFACTORED REACTIONS										
1ST LCASE MAX./MIN. COMPONENT REACTIONS										
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL			
Y	1860	1303 / 0	0 / 0	0 / 0	0 / 0	557 / 0	0 / 0			
O	2101	1470 / 0	0 / 0	0 / 0	0 / 0	631 / 0	0 / 0			
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Y, O										
BRACING										
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.61 FT.										
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.										
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.										
LOADING										
TOTAL LOAD CASES: (4)										
CHORDS WEBS										
MEMB. MAX. FACTORED FORCE (LBS) FACTORED VERT. LOAD (PLF) MAX. UNBRACED LENGTH (LC) MEMB. MAX. FACTORED FORCE (LBS) MAX. UNBRACED LENGTH (LC)										
FR-TO			FROM TO			FR-TO				
A-B	0 / 30		-77.4 -77.4	0.10 (1)	10.00	X-C	-797 / 0	0.18 (1)		
B-C	-2718 / 0		-77.4 -77.4	0.20 (1)	4.02	C-W	0 / 411	0.10 (1)		
C-D	-3093 / 0		-77.4 -77.4	0.23 (1)	3.76	W-D	-165 / 0	0.08 (1)		
D-E	-3660 / 0		-77.4 -77.4	0.35 (1)	3.38	U-F	-199 / 0	0.10 (1)		
E-F	-4589 / 0		-77.4 -77.4	0.46 (1)	2.91	U-G	-1263 / 0	0.69 (1)		
F-G	-4589 / 0		-77.4 -77.4	0.33 (1)	3.02	G-S	0 / 1137	0.28 (1)		
G-H	-5231 / 0		-77.4 -77.4	0.39 (1)	2.76	S-H	-142 / 0	0.07 (1)		
H-I	-5231 / 0		-77.4 -77.4	0.56 (1)	2.61	Q-K	-292 / 0	0.15 (1)		
I-J	-5231 / 0		-77.4 -77.4	0.56 (1)	2.61	Q-L	0 / 492	0.12 (1)		
J-K	-4289 / 0		-77.4 -77.4	0.43 (1)	3.04	P-L	-899 / 0	0.20 (1)		
K-L	-3548 / 0		-77.4 -77.4	0.27 (1)	3.50	B-X	0 / 2311	0.57 (1)		
L-M	-3106 / 0		-77.4 -77.4	0.23 (1)	3.75	P-M	0 / 2639	0.65 (1)		
M-N	0 / 30		-77.4 -77.4	0.10 (1)	10.00	D-V	0 / 2168	0.54 (1)		
Y-B	-2589 / 0		0.0 0.0	0.29 (1)	5.27	V-E	-1731 / 0	0.87 (1)		
O-M	-2930 / 0		0.0 0.0	0.33 (1)	4.97	E-U	0 / 1706	0.42 (1)		
						R-K	0 / 2650	0.66 (1)		
						S-J	0 / 1730	0.43 (1)		
						R-J	-1769 / 0	0.89 (1)		
Y-X	0 / 0		-18.2 -18.2	0.04 (1)	10.00					
X-W	0 / 2184		-18.2 -18.2	0.16 (1)	10.00					
W-V	0 / 2453		-18.2 -18.2	0.16 (1)	10.00					
V-U	0 / 3660		-18.2 -18.2	0.23 (1)	10.00					
U-T	0 / 4927		-18.2 -18.2	0.30 (1)	10.00					
T-S	0 / 4927		-18.2 -18.2	0.30 (1)	10.00					
S-Z	0 / 4289		-18.2 -18.2	0.50 (1)	10.00					
Z-R	0 / 4289		-18.2 -18.2	0.50 (1)	10.00					
R-Q	0 / 2814		-18.2 -18.2	0.22 (1)	10.00					
Q-P	0 / 2494		-18.2 -18.2	0.18 (1)	10.00					
P-O	0 / 0		-18.2 -18.2	0.04 (1)	10.00					
FACTORED CONCENTRATED LOADS (LBS)										
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE			
S	16-14	-1709	-1709	---	FRONT	VERT	TOTAL			
Z	17-16	-947	-947	---	FRONT	VERT	TOTAL			
DESIGN CRITERIA										
*** SPECIAL LOADS ANALYSIS ***										
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.										
LOADS WERE DERIVED FROM USER INPUT NO FURTHER MODIFICATIONS WERE MADE										
SPECIFIED LOADS:										
TOP CH.	LL	=	23.3	PSF						
	DL	=	3.0	PSF						
BOT CH.	LL	=	0.0	PSF						
	DL	=	7.3	PSF						
TOTAL LOAD	=	33.6	PSF							
SPACING = 24.0 IN./C										
LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM										
*** NON STANDARD GIRDER ***										
ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.										
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010										
THIS DESIGN COMPLIES WITH:										
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014										
- CSA 086-09										
- TPIC 2011										
(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD										
ALLOWABLE DEFL.(LL)= L/360 (0.97")										
CALCULATED VERT. DEFL.(LL) = L/999 (0.18")										
ALLOWABLE DEFL.(TL)= L/360 (0.97")										
CALCULATED VERT. DEFL.(TL) = L/999 (0.33")										
CSI: TC=0.56/1.00 (H-J:1), BC=0.50/1.00 (R-S:1), WB=0.89/1.00 (J-R:1), SSI=0.43/1.00 (R-S:1)										
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00										
COMP=1.00 SHEAR=1.00 TENS= 1.00										
COMPANION LIVE LOAD FACTOR = 0.50										
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .										
NAIL VALUES										
PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)							
				MAX	MIN	MAX	MIN	MAX	MIN	
MT20	618	354	1667	822	2284	1656				
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										
TOTAL WEIGHT = 164 LB										
[M]										

TOTAL WEIGHT = 164 lb [M]

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	6.0	8.0	2.75	2.00
C	TMWW-t	MT20	4.0	4.0	2.00	1.50
D	TTWW+m	MT20	8.0	8.0	Edge	3.00
E	TMWW+t	MT20	4.0	5.0	2.00	1.50
F	TMW+w	MT20	2.0	4.0		
G	TMWW+t	MT20	3.0	5.0	1.75	1.50
H	TMW+w	MT20	2.0	4.0		
I	TS-t	MT20	3.0	8.0		
J	TMWW+t	MT20	4.0	5.0	2.00	1.50
K	TTWW+m	MT20	8.0	8.0	Edge	3.00
L	TMWW-t	MT20	4.0	4.0	2.00	1.50
M	TMVW+p	MT20	6.0	8.0	2.75	2.00
O	BMV1+p	MT20	3.0	5.0	2.50	
P	BMWW-t	MT20	4.0	6.0	1.75	1.50
Q	BMWW+t	MT20	3.0	4.0		
R	BMWW+t	MT20	5.0	6.0	2.25	2.00
S	BMWWW+t	MT20	6.0	8.0	4.25	1.50
T	BS-t	MT20	5.0	6.0		
U	BMWWW+t	MT20	6.0	8.0	4.25	2.00
V	BMWW+t	MT20	5.0	6.0	2.25	2.00
W	BMWW+t	MT20	3.0	4.0		
X	BMWW-t	MT20	4.0	6.0	1.75	1.50
Y	BMV1+p	MT20	3.0	5.0	2.50	0.50

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

CONTINUED ON PAGE 2



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN YORK HOMES - GRANELLI HOME COPR - AMELIA 1 ELE 1	DRWG NO.
NE0518-221	G01	1	1	TRUSS DESC.		PAGE 4 OF 42


Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu May 31 15:50:00 2018 Page 2
ID:JIDzXONJoFa2AxdT?3zOcwzBMzn-RmTnAVYOGRrd3Sm4bJkAJE9JJgYkWBmz7TaXUEzAy6L

HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S)
REQUIRED TO SUPPORT CONCENTRATED
LOAD(S) 1709.4 lbs FACTORED DOWN AT
16-1-4, AND 946.5 lbs FACTORED DOWN AT
17-1-6 ON BOTTOM CHORD. DESIGN FOR
UNSPECIFIED CONNECTION(S) IS DELEGATED
TO THE BUILDING DESIGNER.

PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.88 (M) (INPUT = 0.90)
JSI METAL= 0.80 (T) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



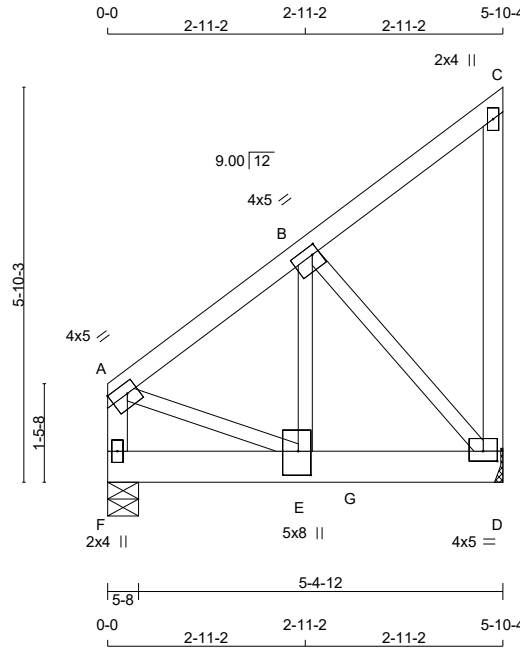

TOTAL WEIGHT = 33 lb [M]

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF
F - A	2x4	DRY	No.2	SPF
F - D	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	4.0	5.0	1.75	Edge
B	TMVW-t	MT20	4.0	5.0	1.50	1.25
C	TMV+p	MT20	2.0	4.0		
D	BMVW1-t	MT20	4.0	5.0	1.75	2.50
E	BMVW+t	MT20	5.0	8.0	4.25	2.25
F	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES

- 1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 1574.2 lbs FACTORED DOWN AT 2-9-0 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
D	1710	0	1710	0	MECHANICAL	
F	1395	0	1395	0	5-8	

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT D TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
D	1201	833 / 0	0 / 0	0 / 0	0 / 0	368 / 0	0 / 0
F	980	680 / 0	0 / 0	0 / 0	0 / 0	301 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.53 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS				WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	MAX (LC)	MAX. MEMB. UNBRACED LENGTH FR-TO	MAX. FACTORED FORCE (LBS)	MAX (LC)	MAX (LC)
FR-TO		FROM	TO					
A-B	-1290 / 0	-77.4	-77.4	0.12 (1)	5.53	E-B	0 / 1666	0.41 (1)
B-C	-13 / 0	-77.4	-77.4	0.10 (1)	6.25	B-D	-1555 / 0	0.48 (1)
D-C	-91 / 0	0.0	0.0	0.05 (1)	7.81	A-E	0 / 1107	0.27 (1)
F-A	-1246 / 0	0.0	0.0	0.14 (1)	7.16			
F-E	0 / 0	-107.4	-107.4	0.08 (1)	10.00			
E-G	0 / 1042	-18.2	-18.2	0.37 (1)	10.00			
G-D	0 / 1042	-342.9	-342.9	0.37 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
E	2-9-0	-1574	-1574	---	BACK	VERT	TOTAL

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL = 23.3 PSF
	DL = 3.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.3 PSF
TOTAL LOAD	= 33.6 PSF

SPACING = 24.0 IN./C

GIRDER TYPE: CStdGirder
START DISTANCE = 3-8-0
START SPAN CARRIED = 16-0-8
END DISTANCE = 5-10-4
END SPAN CARRIED = 16-0-8
END WALL WIDTH = 5-8
APPLIED TO BACK SIDE OF BOTTOM CHORD.
- ADDTL LOADS BASED ON 55 % OF GSL.
(DEFINED BY USER)

GIRDER TYPE: CStdGirder
START DISTANCE = 0-0
START SPAN CARRIED = 5-10-4
END DISTANCE = 2-9-0
END SPAN CARRIED = 5-10-4
END WALL WIDTH = 1-8
APPLIED TO FRONT SIDE OF BOTTOM CHORD.
- ADDTL LOADS BASED ON 55 % OF GSL.
(DEFINED BY USER)

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.14/1.00 (A-F:1), BC=0.37/1.00 (D-E:1), WB=0.48/1.00 (B-D:1), SSI=0.31/1.00 (D-E:1)

CONTINUED ON PAGE 2



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN YORK HOMES - GRANELLI HOME COPR - AMELIA 1 ELE 1	DRWG NO.
NE0518-221	G02	1	1	TRUSS DESC.		PAGE 6 OF 42

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu May 31 15:50:00 2018 Page 2
ID:JiDzXONJoFa2AxdT?3zOcwzBMzn-RmTnAVYOGRRd3Sm4bJkAJE9PvgamWHtz7TaXUEzAy6L

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT
RESPONSIBLE FOR QUALITY CONTROL IN
THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (E) (INPUT = 0.90)
JSI METAL= 0.41 (A) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



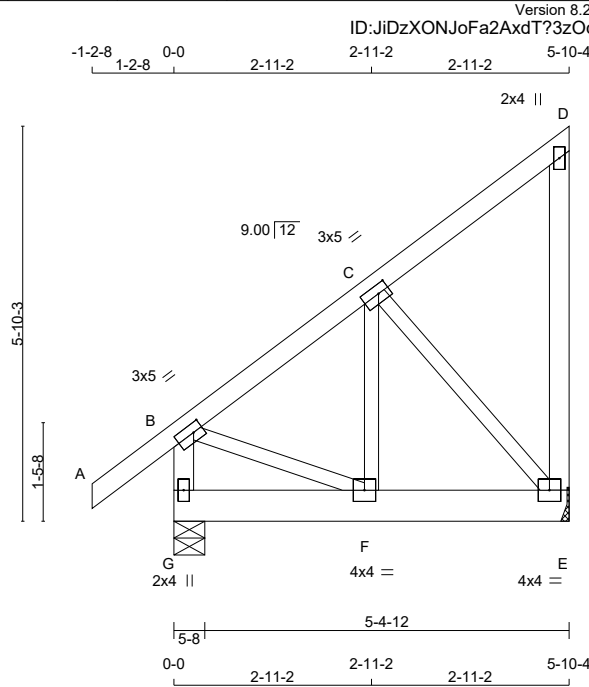

Scale = 1:34.1

TOTAL WEIGHT = 35 lb [M]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF
G - B	2x4	DRY	No.2	SPF
G - E	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
DRY: SEASONED LUMBER.				

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	3.0	5.0	1.50	1.75
C	TMWW-t	MT20	3.0	5.0	1.50	2.00
D	TMV+p	MT20	2.0	4.0		
E	BMVW1-t	MT20	4.0	4.0		
F	BMWW-t	MT20	4.0	4.0		
G	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQRD
		GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UP	IN-SX
E	947	0	947	0	MECHANICAL
G	1047	0	1047	0	5-8

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT E TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN	COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
E	665	461/0	0/0	0/0	0/0	204/0
G	733	522/0	0/0	0/0	0/0	212/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0/30	-77.4	-77.4 0.10 (1)	F-C	0/662	0.16 (1)	
B-C	-616/0	-77.4	-77.4 0.12 (1)	C-E	-754/0	0.23 (1)	
C-D	-15/0	-77.4	-77.4 0.11 (1)	B-F	0/537	0.13 (1)	
E-D	-88/0	0.0	0.0 0.05 (1)				
G-B	-748/0	0.0	0.0 0.08 (1)				
G-F	0/0	-246.1	-246.1 0.13 (1)				
F-E	0/505	-246.1	-246.1 0.20 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN./C

GIRDER TYPE: CStdGirder
START DISTANCE = 0-0
START SPAN CARRIED = 11-11-14
END DISTANCE = 5-10-4
END SPAN CARRIED = 11-11-14
END WALL WIDTH = 5-8
APPLIED TO FRONT SIDE OF BOTTOM CHORD.
- ADDTL LOADS BASED ON 55 % OF GSL.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/999 (0.01")

CSI: TC=0.12/1.00 (B-C:1), BC=0.20/1.00 (E-F:1), WB=0.23/1.00 (C-E:1), SSI=0.28/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

CONTINUED ON PAGE 2



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN YORK HOMES - GRANELLI HOME COPR - AMELIA 1 ELE 1	DRWG NO.
NE0518-221	G03	1	1	TRUSS DESC.		PAGE 8 OF 42


Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu May 31 15:50:01 2018 Page 2
ID:JiDzXONJoFa2AxdT?3zOcwzBMzn-vy19NrY01IzUhclG90FPrRib14ycFoy6M7K51gzAy6k

JSI GRIP= 0.88 (C) (INPUT = 0.90)
JSI METAL= 0.22 (B) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu May 31 15:50:02 2018 Page 1
ID: JiDzXONJoFa2AxdT?3zOcwzBMzn-N9bYbAZeo25LImwSikneOfFbiTDH 6EGan3eZ6zAy6

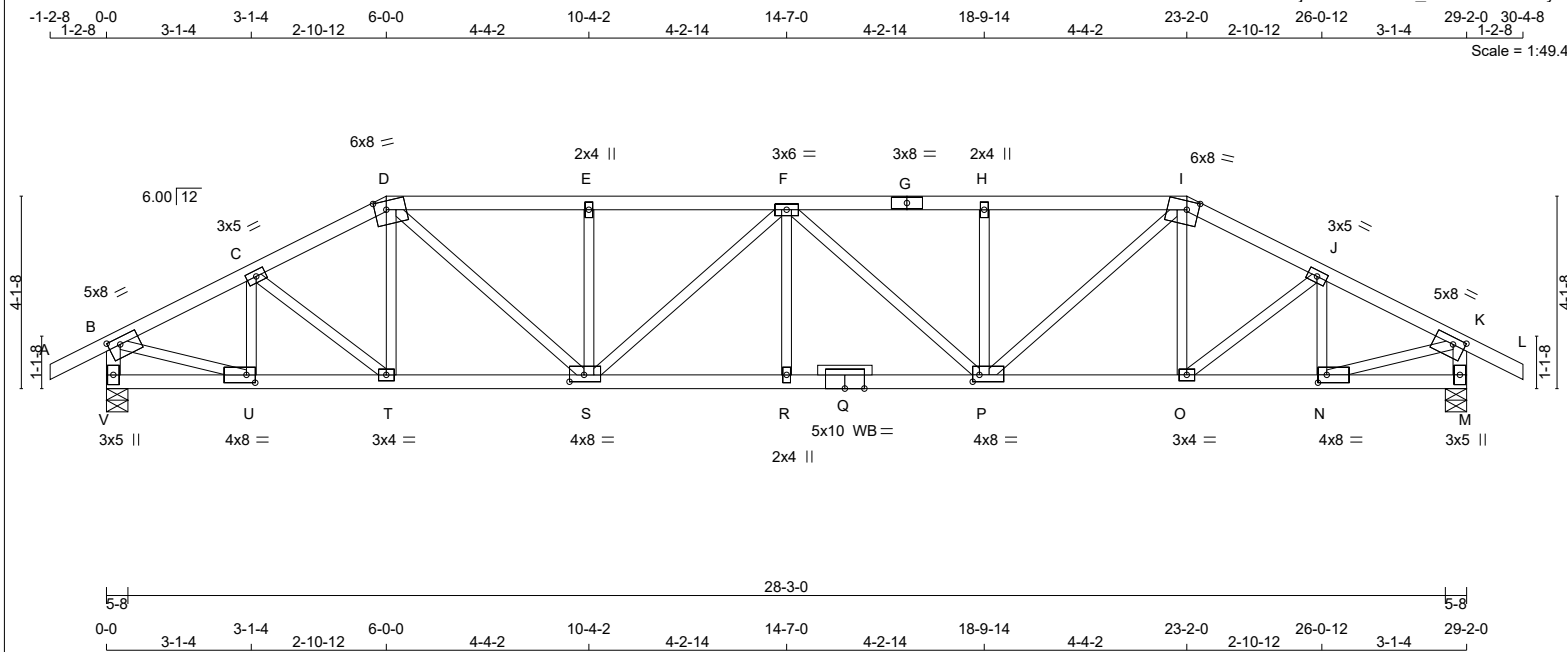

TOTAL WEIGHT = 120 lb

N. L. G. A. RULES

CHORDS		SIZE	LUMBER	DESCR
A - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
I - L	2x4	DRY	No.2	SPF
V - B	2x4	DRY	No.2	SPF
M - K	2x4	DRY	No.2	SPF
V - Q	2x4	DRY	2100F 1.8E	SPF
Q - M	2x4	DRY	2100F 1.8E	SPF

ALL WEBS	2x3	DRY	No.2	SPF
----------	-----	-----	------	-----

DRY: SEASONED LUMBER.

JT TYPE	PLATES
1	1
2	2
3	3
4	4
5	5
6	6
7	7
8	8
9	9
10	10
11	11
12	12
13	13
14	14
15	15
16	16
17	17
18	18
19	19
20	20
21	21
22	22
23	23
24	24
25	25
26	26
27	27
28	28
29	29
30	30
31	31
32	32
33	33
34	34
35	35
36	36
37	37
38	38
39	39
40	40
41	41
42	42
43	43
44	44
45	45
46	46
47	47
48	48
49	49
50	50
51	51
52	52
53	53
54	54
55	55
56	56
57	57
58	58
59	59
60	60
61	61
62	62
63	63
64	64
65	65
66	66
67	67
68	68
69	69
70	70
71	71
72	72
73	73
74	74
75	75
76	76
77	77
78	78
79	79
80	80
81	81
82	82
83	83
84	84
85	85
86	86
87	87
88	88
89	89
90	90
91	91
92	92
93	93
94	94
95	95
96	96
97	97
98	98
99	99
100	100

J	T	TYPE	PLATES	W	LEN	Y	X
B	T	TMVW-t	MT20	5.0	8.0	1.75	3.00
C	T	TMVW-t	MT20	3.0	5.0		
D	T	TTVW-m	MT20	6.0	8.0	2.25	3.00
E	T	TMW-w	MT20	2.0	4.0		
F	T	BMVWVW-t	MT20	3.0	6.0		
G	T	TS-t	MT20	3.0	8.0		
H	T	TMW-w	MT20	2.0	4.0		
I	T	TTVW-m	MT20	6.0	8.0	2.25	3.00
J	T	TMVW-t	MT20	3.0	5.0		
K	T	TMVW-t	MT20	5.0	8.0	1.75	3.00
M	N	BMV1+p	MT20	3.0	5.0		
N	N	BMVW-t	MT20	4.0	8.0	2.00	2.25
O	N	BMVW-t	MT20	3.0	4.0		
P	N	BMVWVW-t	MT20	4.0	8.0	1.75	1.75
Q	N	BS-t	MT20	5.0	10.0		
R	N	BMW-w	MT20	2.0	4.0		
S	N	BMVWVW-t	MT20	4.0	8.0	1.75	3.75
T	N	BMVW-t	MT20	3.0	4.0		
U	N	BMVW-t	MT20	4.0	8.0	2.00	2.25
V	N	BMV1+p	MT20	3.0	5.0		

WB - INDICATES BLOCKING REQUIRED



DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FA

	FACTORED		MAXIMUM FACTORED			INPUT	REQRD
	GROSS REACTION		GROSS REACTION			BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
V	2665	0	2665	0	0	5-8	5-8
M	2665	0	2665	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
V	1871	1302 / 0	0 / 0	0 / 0	0 / 0	569 / 0	0 / 0
M	1871	1302 / 0	0 / 0	0 / 0	0 / 0	569 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.37 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)		
FR-TO		FROM TO		LENGTH	FR-TO				
A-B	0 / 22	-77.4	-77.4	0.10 (1)	10.00	U-C	-760 / 0 0.14 (1)		
B-C	-3505 / 0	-77.4	-77.4	0.28 (1)	3.50	C-T	0 / 483 0.12 (1)		
C-D	-3946 / 0	-77.4	-77.4	0.30 (1)	3.28	T-D	-135 / 82 0.04 (1)		
D-E	-4869 / 0	-145.9	-145.9	0.83 (1)	2.37	D-S	0 / 1803 0.45 (1)		
E-F	-4869 / 0	-145.9	-145.9	0.82 (1)	2.37	S-E	-693 / 0 0.19 (1)		
F-G	-4869 / 0	-145.9	-145.9	0.82 (1)	2.37	S-F	-551 / 0 0.31 (1)		
G-H	-4869 / 0	-145.9	-145.9	0.82 (1)	2.37	R-F	0 / 163 0.06 (4)		
H-I	-4869 / 0	-145.9	-145.9	0.83 (1)	2.37	F-P	-551 / 0 0.31 (1)		
I-J	-3946 / 0	-77.4	-77.4	0.30 (1)	3.28	P-H	-693 / 0 0.19 (1)		
J-K	-3505 / 0	-77.4	-77.4	0.28 (1)	3.50	P-I	0 / 1803 0.45 (1)		
K-L	0 / 22	-77.4	-77.4	0.10 (1)	10.00	O-I	-135 / 82 0.04 (1)		
V-B	-2601 / 0	0.0	0.0	0.29 (1)	5.26	O-J	0 / 483 0.12 (1)		
M-K	-2601 / 0	0.0	0.0	0.29 (1)	5.26	N-J	-760 / 0 0.14 (1)		
						B-U	0 / 3247 0.80 (1)		
						N-K	0 / 3247 0.80 (1)		
V-U	0 / 0	-34.4	-34.4	0.06 (4)	10.00				
U-T	0 / 3141	-34.4	-34.4	0.31 (1)	10.00				
T-S	0 / 3516	-34.4	-34.4	0.34 (1)	10.00				
S-R	0 / 5278	-34.4	-34.4	0.49 (1)	10.00				
R-Q	0 / 5278	-34.4	-34.4	0.49 (1)	10.00				
Q-P	0 / 5278	-34.4	-34.4	0.49 (1)	10.00				
P-O	0 / 3516	-34.4	-34.4	0.34 (1)	10.00				
O-N	0 / 3141	-34.4	-34.4	0.31 (1)	10.00				
N-M	0 / 0	-34.4	-34.4	0.06 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
D	6-0-0	-348	-348	---	FRONT	VERT	TOTAL
I	23-2-0	-348	-348	---	FRONT	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:

TOP	CH.	LL	=	23.3	PSF
		DL	=	3.0	PSF
BOT	CH.	LL	=	0.0	PSF
		DL	=	7.3	PSF
TOTAL LOAD			=	33.6	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A
SLOPE OF 2.00/12 MINIMUM

GIRDER TYPE: CPrimeHip
SIDE SETBACK = 6-0-0
END SETBACK = 6-0-0
END WALL WIDTH = 5-8
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO FRONT SIDE
- ADD'L LOADS BASED ON 55 % OF GSL.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.24")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/ 815 (0.43")

CSI: TC=0.83/1.00 (H-I:1) , BC=0.49/1.00 (P-R:1) ,
WB=0.80/1.00 (K-N:1) , SSI=0.32/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)	(PLI)	(PSI)	(PLI)	(PSI)	(PLI)
MT20	618	354	1667	822	2284	1656

CONTINUED ON PAGE 2



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
NE0518-221	G04	1	1	GREEN YORK HOMES - GRANELLI HOME COPR - AMELIA 1 ELE 1	PAGE 10 OF 42
TRUSS DESC.					


Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu May 31 15:50:02 2018 Page 2
ID:JiDzXONJoFa2AxdT?3zOcwzBMzn-N9bYbAZeo25LlmwSjkneOfFbiTDH_6EGan3eZ6zAy6J

HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S)
REQUIRED TO SUPPORT CONCENTRATED
LOAD(S) 348.1 lbs FACTORED DOWN AT 23-2-0,
AND 348.1 lbs FACTORED DOWN AT 6-0-0 ON
TOP CHORD. DESIGN FOR UNSPECIFIED
CONNECTION(S) IS DELEGATED TO THE
BUILDING DESIGNER.

PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.89 (U) (INPUT = 0.90)
JSI METAL= 0.96 (Q) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



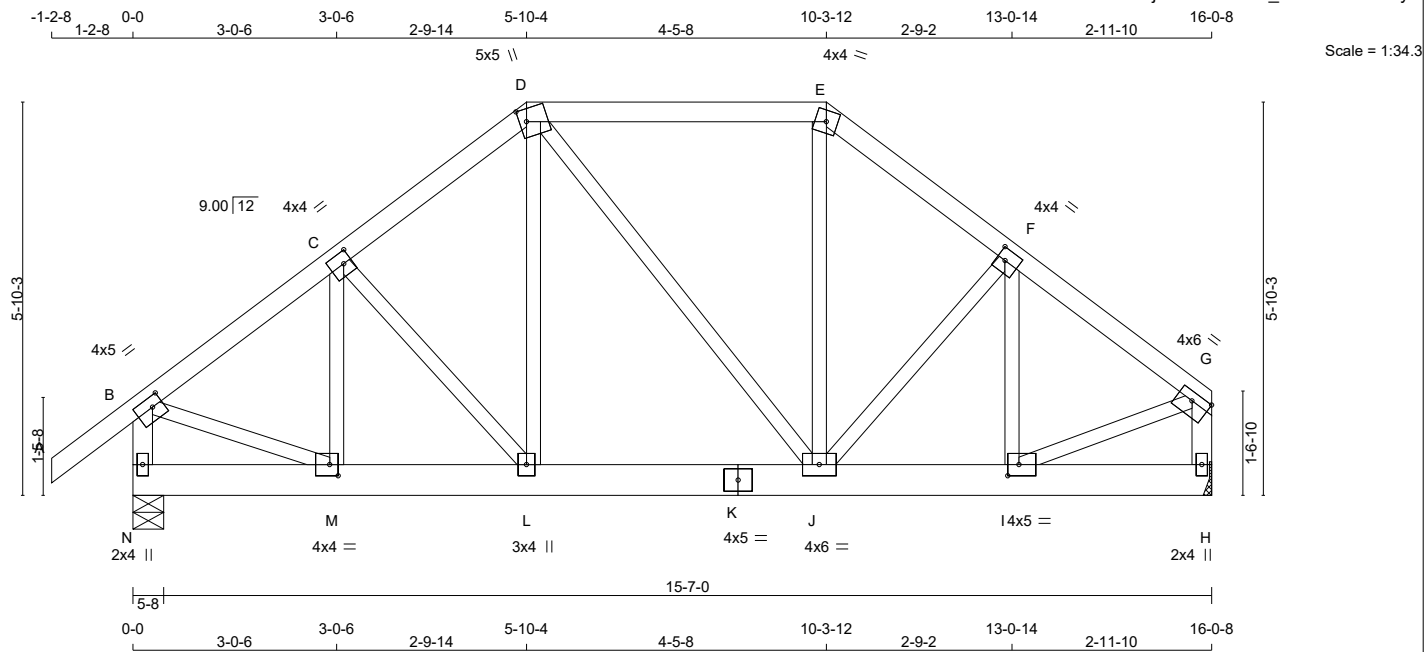

TOTAL WEIGHT = 84 lb [M]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
N - B	2x4	DRY	No.2	SPF
H - G	2x4	DRY	No.2	SPF
N - K	2x6	DRY	No.2	SPF
K - H	2x6	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	5.0	1.75	2.00
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TTWW+m	MT20	5.0	5.0	2.25	1.25
E	TTW-m	MT20	4.0	4.0		
F	TMVW-t	MT20	4.0	4.0	2.00	1.50
G	TMVW-t	MT20	4.0	6.0	1.50	Edge
H	BMV1+p	MT20	2.0	4.0		
I	BMVW-t	MT20	4.0	5.0	2.00	2.00
J	BMVW-t	MT20	4.0	6.0		
K	BS-t	MT20	4.0	5.0		
L	BMVW-t	MT20	3.0	4.0		
M	BMVW-t	MT20	4.0	4.0	2.00	1.50
N	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES

- SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 321.6 lbs FACTORED DOWN AT 10-3-12 ON TOP CHORD, AND 821.3 lbs FACTORED DOWN AT 10-3-0 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	UPLIFT	IN-SX
N	1297	0	0	5-8
H	1570	0	0	5-8 MECHANICAL

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT H TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. SNOW	COMPONENT LIVE	PERM. LIVE	WIND	DEAD	SOIL
N	908	649 / 0	0 / 0	0 / 0	0 / 0	259 / 0	0 / 0
H	1106	753 / 0	0 / 0	0 / 0	0 / 0	353 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 30	-77.4	-77.4 0.10 (1)	M-C	-317 / 0	0.07	(1)
B-C	-1200 / 0	-77.4	-77.4 0.13 (1)	C-D	0 / 29	0.01	(1)
C-D	-1257 / 0	-77.4	-77.4 0.13 (1)	D-E	0 / 85	0.03	(4)
D-E	-1318 / 0	-77.4	-77.4 0.33 (1)	E-F	0 / 522	0.13	(1)
E-F	-1656 / 0	-77.4	-77.4 0.13 (1)	F-G	0 / 413	0.10	(1)
F-G	-1554 / 0	-77.4	-77.4 0.13 (1)	G-H	0 / 88	0.02	(1)
N-B	-1258 / 0	0.0	0.0 0.14 (1)	H-I	-383 / 0	0.09	(1)
H-G	-1515 / 0	0.0	0.0 0.17 (1)	I-G	0 / 1028	0.25	(1)
N-M	0 / 0	-18.2	-18.2 0.03 (1)		0 / 1343	0.33	(1)
M-L	0 / 972	-18.2	-18.2 0.15 (1)				
L-K	0 / 992	-18.2	-18.2 0.16 (1)				
K-J	0 / 992	-18.2	-18.2 0.16 (1)				
J-I	0 / 1253	-33.7	-33.7 0.20 (1)				
I-H	0 / 0	-33.7	-33.7 0.04 (4)				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
E	10-3-12	-322	-322	---	FRONT	VERT	TOTAL
J	10-3-0	-821	-821	---	FRONT	VERT	TOTAL

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.3	PSF
TOTAL LOAD		=	33.6	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

GIRDER TYPE: CPrimeHip
LEFT SETBACK = 5-10-4
RIGHT SETBACK = 5-8-12
END SETBACK = 5-10-4
END WALL WIDTH = 5-8
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO FRONT SIDE
- ADDTL LOADS BASED ON 55 % OF GSL.
LOADS APPLIED TO FIRST 5-8-12 OF SPAN MEASURED FROM THE RIGHT.

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.53")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL)= L/360 (0.53")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.33/1.00 (D-E:1), BC=0.20/1.00 (I-J:1), WB=0.33/1.00 (G-I:1), SSI=0.15/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

CONTINUED ON PAGE 2



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN YORK HOMES - GRANELLI HOME COPR - AMELIA 1 ELE 1	DRWG NO.
NE0518-221	G05	1	1	TRUSS DESC.		PAGE 12 OF 42

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu May 31 15:50:03 2018 Page 2
ID:JiDzXONJoFa2AxdT?3zOcwzBMzn-rL9woVaGYMDBwwVfGRltwsntDtd0jgrPpRpC5YzAy6

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (M) (INPUT = 0.90)

JSI METAL= 0.41 (G) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



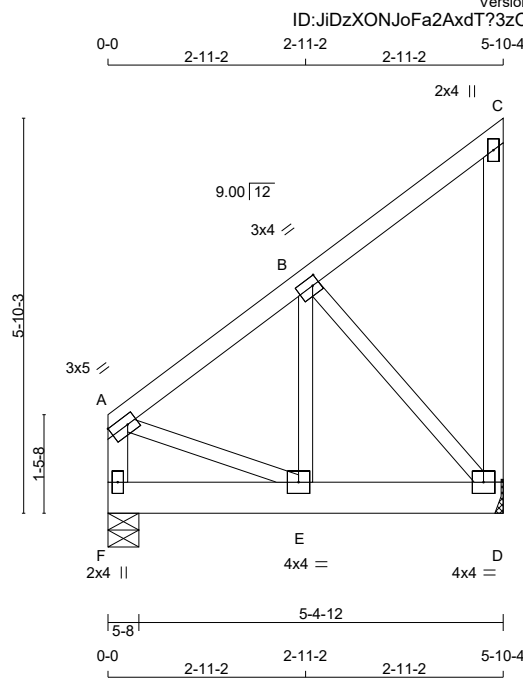

TOTAL WEIGHT = 33 lb [M]

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF
F - A	2x4	DRY	No.2	SPF
F - D	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	3.0	5.0	1.50	Edge
B	TMWW-t	MT20	3.0	4.0	1.50	1.25
C	TMV+p	MT20	2.0	4.0		
D	BMVW1-t	MT20	4.0	4.0		
E	BMWW-t	MT20	4.0	4.0		
F	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
D	821	0	821	0	0	MECHANICAL
F	821	0	821	0	0	5-8

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT D TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
D	577	400/0	0/0	0/0	0/0	177/0	0/0
F	577	400/0	0/0	0/0	0/0	177/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO		FROM	TO			FR-TO		
A-B	-533 / 0	-77.4	-77.4	0.12 (1)	6.25	E-B	0 / 537	0.13 (1)
B-C	-15 / 0	-77.4	-77.4	0.11 (1)	6.25	B-D	-654 / 0	0.20 (1)
D-C	-88 / 0	0.0	0.0	0.05 (1)	7.81	A-E	0 / 466	0.12 (1)
F-A	-573 / 0	0.0	0.0	0.06 (1)	7.81			
F-E	0 / 0	-203.0	-203.0	0.11 (1)	10.00			
E-D	0 / 438	-203.0	-203.0	0.17 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	PSF
LL	23.3	PSF
DL	3.0	PSF
BOT CH.	LL	PSF
LL	0.0	PSF
DL	7.3	PSF
TOTAL LOAD	33.6	PSF

SPACING = 24.0 IN. C/C

GIRDER TYPE: CStd Girder
START DISTANCE = 0-0
START SPAN CARRIED = 10-2-4
END DISTANCE = 5-10-4
END SPAN CARRIED = 10-2-4
END WALL WIDTH = 5-8
APPLIED TO FRONT SIDE OF BOTTOM CHORD.
- ADDTL LOADS BASED ON 55 % OF GSL.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/999 (0.01")

CSI: TC=0.12/1.00 (A-B:1), BC=0.17/1.00 (D-E:1), WB=0.20/1.00 (B-D:1), SSI=0.23/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

CONTINUED ON PAGE 2



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN YORK HOMES - GRANELLI HOME COPR - AMELIA 1 ELE 1	DRWG NO.
NE0518-221	G06	1	1	TRUSS DESC.		PAGE 14 OF 42

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu May 31 15:50:03 2018 Page 2
ID:JiDzXONJoFa2AxdT?3zOcwzBMzn-rL9woWaGYMDBwwVfGRltwsnxWteajiwPpRpC5YzAy6I

JSI GRIP= 0.82 (B) (INPUT = 0.90)
JSI METAL= 0.18 (A) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



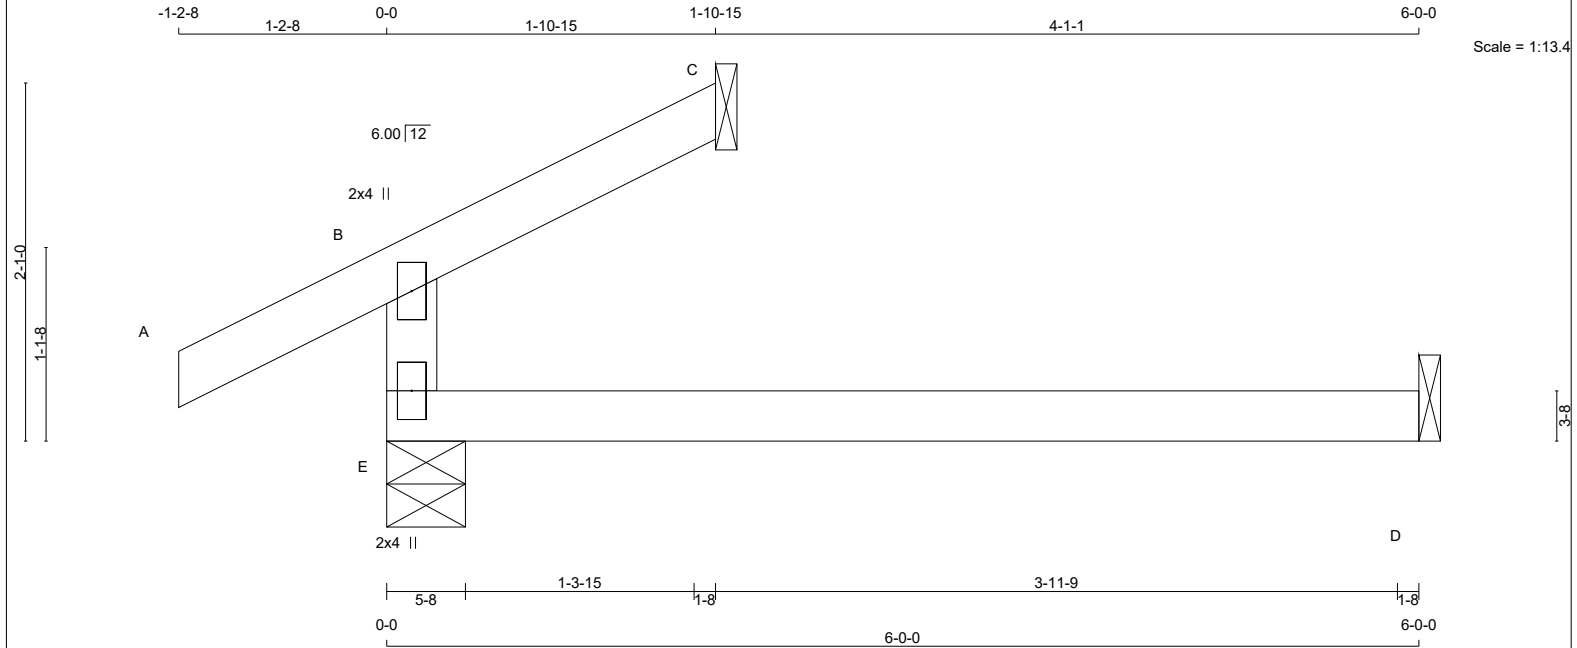

TOTAL WEIGHT = 2 X 12 = 23 lb [M][F]

LUMBER
N. L. G. A. RULES
CHORDS SIZE DRY LUMBER DESCR. SPF
E - B 2x4 No.2
A - C 2x4 DRY No.2
E - D 2x4 DRY No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
E	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
E	255	0	255	0	0	5-8	5-8	
C	56	0	56	0	0	1-8	1-8	
D	45	0	50	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

JT	UNFACTORED REACTIONS		1ST LCASE		MAX./MIN. COMPONENT REACTIONS			
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
E	181	115/0	0/0	0/0	0/0	66/0	0/0	
C	38	34/0	0/0	0/0	0/0	4/0	0/0	
D	36	0/0	0/0	0/0	0/0	36/0	0/0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

MEMB.	CHORDS		WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (LC)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO		
E-B	-191/0	0.0 0.0 0.11 (4)	7.81			
A-B	0/22	-77.4 -77.4 0.09 (1)	10.00			
B-C	-8/0	-77.4 -77.4 0.04 (1)	10.00			
E-D	0/0	-18.2 -18.2 0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.03")

CSI: TC=0.11/1.00 (B-E:4), BC=0.14/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.09/1.00 (D-E:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.11 (B) (INPUT = 0.90)
JSI METAL= 0.04 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



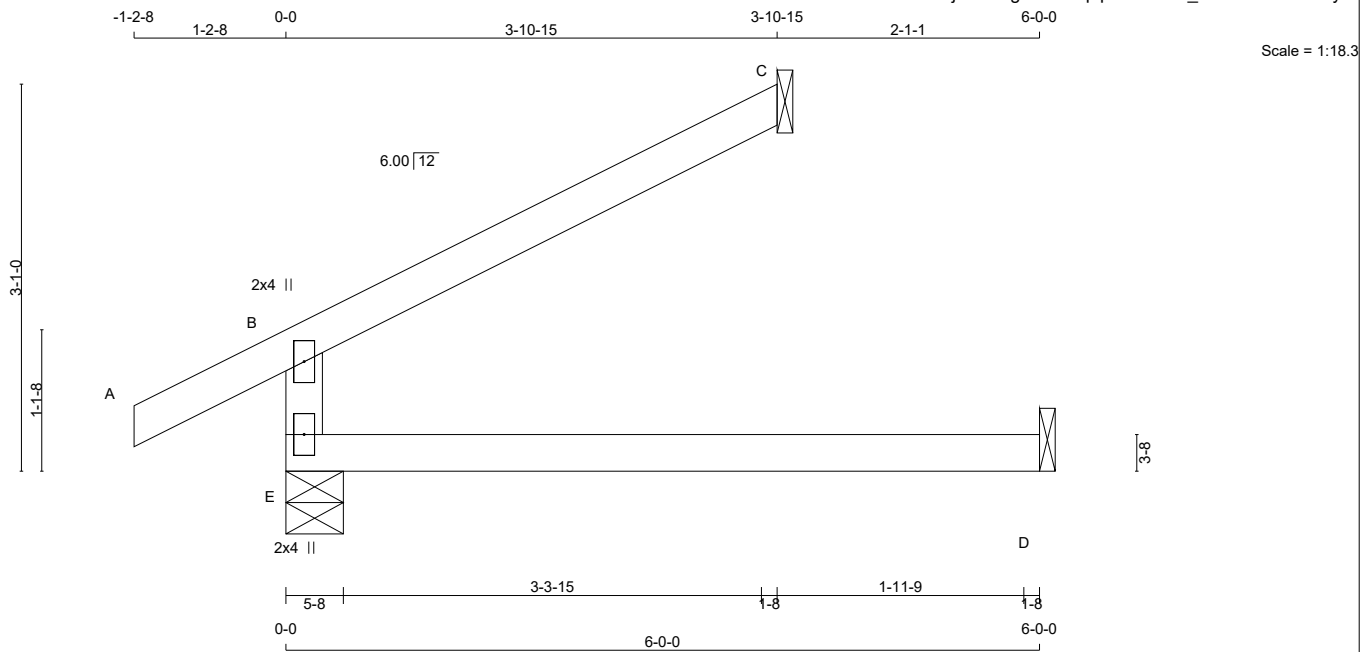

TOTAL WEIGHT = 2 X 14 = 29 lb
[M][F]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	2.0	4.0
E	BMV1+p	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
E	352	0	352	0	0	5-8	5-8	
C	114	0	114	0	0	1-8	1-8	
D	45	0	50	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED		MAX./MIN. SNOW		LIVE		PERM. LIVE		WIND		DEAD		SOIL	
	VERT	HORZ	DOWN	HORZ	DOWN	HORZ	DOWN	HORZ	DOWN	HORZ	DOWN	HORZ	DOWN	HORZ
E	247	173 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	74 / 0	0 / 0	0 / 0	0 / 0
C	77	68 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0	0 / 0	0 / 0
D	36	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)		FACTORED VERT. LOAD (PLF)		LC1 MAX. CSI (LC)		WEBS MAX. FACTORED FORCE (LBS)		MEMB. UNBRACED LENGTH FR-TO	
	FROM	TO	FROM	TO	FROM	TO	FROM	TO	FROM	TO
E-B	-288 / 0	0.0	0.0	0.0	0.11 (4)	7.81				
A-B	0 / 22	-77.4	-77.4	0.09 (1)	10.00					
B-C	-17 / 0	-77.4	-77.4	0.15 (1)	6.25					
E-D	0 / 0	-18.2	-18.2	0.14 (4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
DL =	3.0	PSF	
BOT CH.	LL =	0.0	PSF
DL =	7.3	PSF	
TOTAL LOAD =	33.6	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.03")

CSI: TC=0.15/1.00 (B-C:1), BC=0.14/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES				
PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN
MT20	618	354	1667	822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (B) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



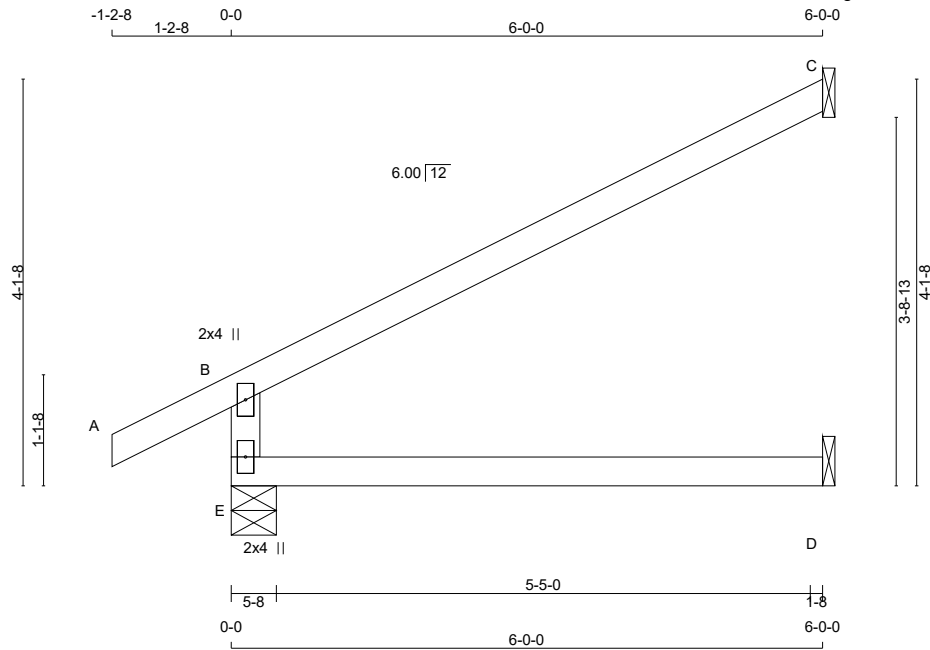

TOTAL WEIGHT = 10 X 17 = 169 lb
[M][F]

LUMBER					DESCR.	SPF
N. L. G. A. RULES	CHORDS	SIZE	LUMBER			
E - B	2x4	DRY	No.2		SPF	
A - C	2x4	DRY	No.2		SPF	
E - D	2x4	DRY	No.2		SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	2.0	4.0	
E	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
E	453	0	453	0	0	5-8	5-8	
C	174	0	174	0	0	1-8	1-8	
D	45	0	50	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C , D

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
E	316	234 / 0	0 / 0	0 / 0	0 / 0	82 / 0	0 / 0
C	118	105 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0
D	36	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		WEBS		FACTORED	
	MAX. FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	MAX. MEMB. UNBRACED LENGTH	FR-TO	MAX. FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO					
E-B	-389 / 0	0.0	0.0	0.11 (4)	7.81			
A-B	0 / 22	-77.4	-77.4	0.09 (1)	10.00			
B-C	-26 / 0	-77.4	-77.4	0.36 (1)	6.25			
E-D	0 / 0	-18.2	-18.2	0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.3	PSF
TOTAL LOAD	=	33.6	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.03")

CSI: TC=0.36/1.00 (B-C:1), BC=0.14/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SSI=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES	PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
		MAX MIN	MAX MIN
MT20	618	354 1667	822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.22 (B) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



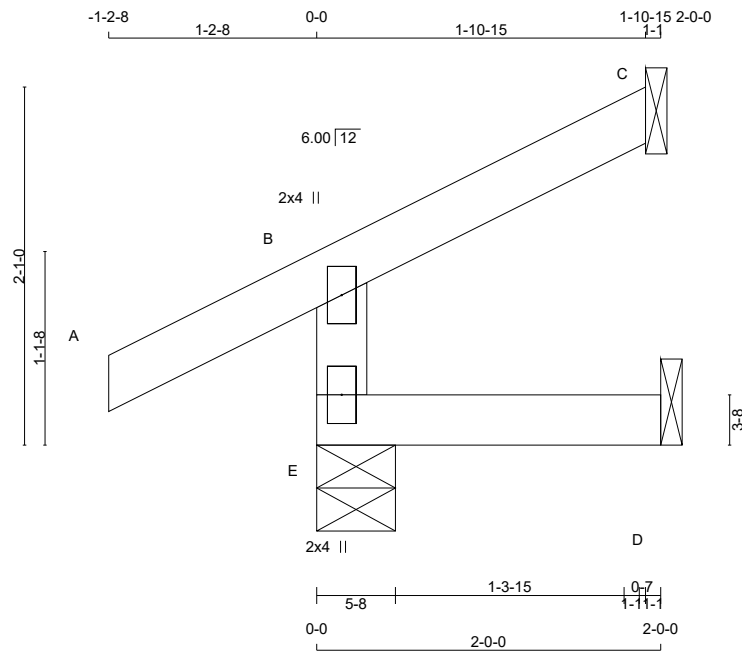

Scale = 1:13.4

TOTAL WEIGHT = $2 \times 7 = 14 \text{ lb}$

LUMBER

N. L. G. A. RULES

CHORDS	SIZE		LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
E	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED		MAXIMUM FACTORED		INPUT	REQD
	GROSS	REACTION	GROSS	REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
E	211	0	211	0	0	5-8
C	56	0	56	0	0	1-8
D	16	0	18	0	0	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C , D

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	146	115 / 0	0 / 0	0 / 0	0 / 0	31 / 0	0 / 0
C	38	34 / 0	0 / 0	0 / 0	0 / 0	4 / 0	0 / 0
D	13	0 / 0	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM	TO		FR-TO		
E-B	-191 / 0	0.0	0.0	0.01 (4)		7.81	
A-B	0 / 22	-77.4	-77.4	0.09 (1)		10.00	
B-C	-8 / 0	-77.4	-77.4	0.05 (1)		10.00	
E-D	0 / 0	-18.2	-18.2	0.02 (4)		10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**

DESIGN CRITERIA

SPECIFIED LOADS:

TOP	CH.	LL	=	23.3	PSF
		DL	=	3.0	PSF
BOT	CH.	LL	=	0.0	PSF
		DL	=	7.3	PSF
TOTAL LOAD				=	33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.00")

CSI: TC=0.09/1.00 (A-B:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.07/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES


PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.11 (B) (INPUT = 0.90)
JSI METAL= 0.04 (B) (INPUT = 1.00)



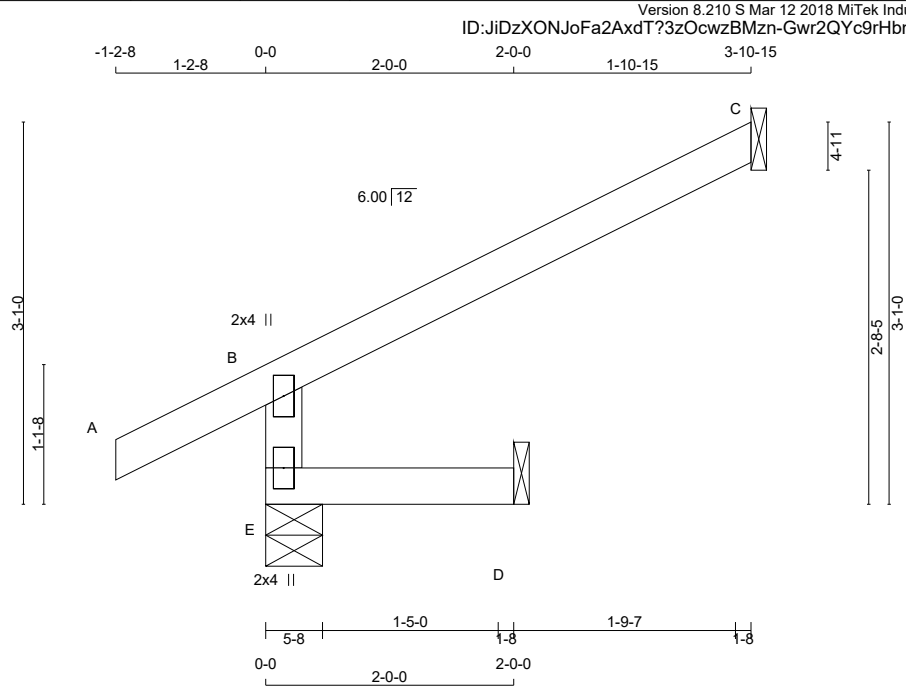

TOTAL WEIGHT = 2 X 10 = 19 lb [M]

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
E	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
E	308	0	308	0	5-8	5-8
C	114	0	114	0	1-8	1-8
D	16	0	18	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C , D

UNFACTORED REACTIONS								
JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND			
E	212	173 / 0	0 / 0	0 / 0	0 / 0	39 / 0	0 / 0	
C	77	68 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0	
D	13	0 / 0	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS				WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX	MAX. MEMB. UNBRACED LENGTH	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1
FR-TO		FROM	TO					
E-B	-288 / 0	0.0	0.0	0.01 (4)	7.81			
A-B	0 / 22	-77.4	-77.4	0.09 (1)	10.00			
B-C	-17 / 0	-77.4	-77.4	0.20 (1)	6.25			
E-D	0 / 0	-18.2	-18.2	0.02 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.00")

CSI: TC=0.20/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (B) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



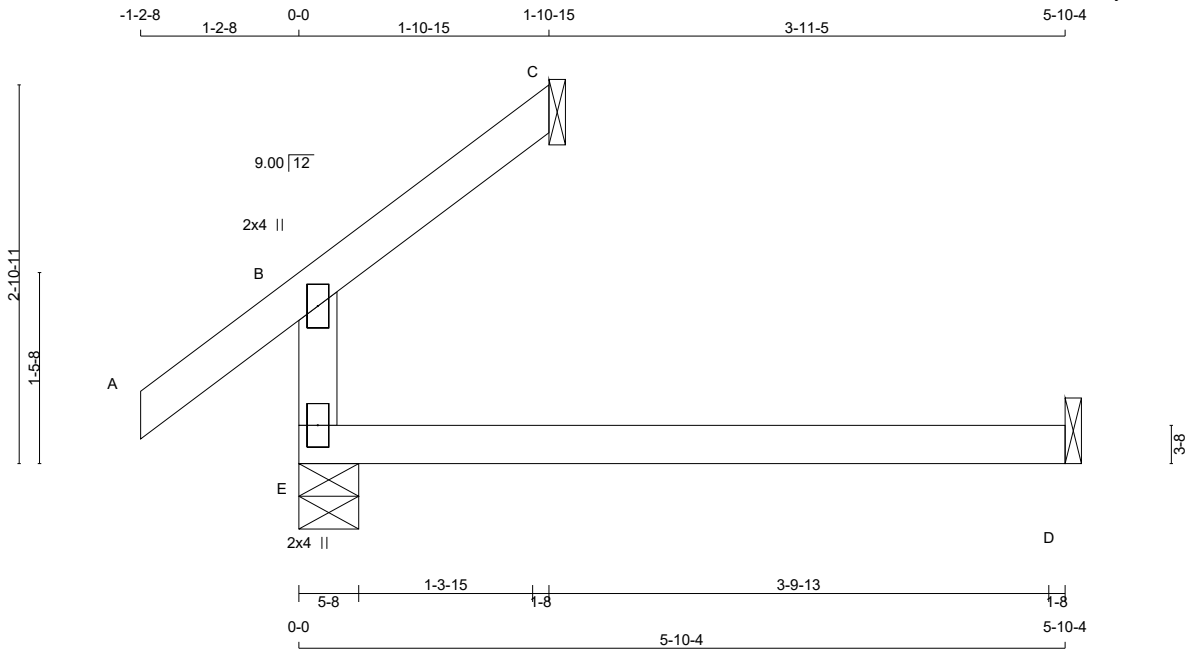

TOTAL WEIGHT = 13 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	2.0	4.0
E	BMV1+p	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
E	254	0	254	0	5-8	5-8
C	56	0	56	0	1-8	1-8
D	45	0	50	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
E	180	116 / 0	0 / 0	0 / 0	0 / 0	64 / 0	0 / 0
C	38	34 / 0	0 / 0	0 / 0	0 / 0	4 / 0	0 / 0
D	36	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		WEBS		FACTORED	
	MAX. FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	MAX. MEMB. UNBRAC LENGTH	FR-TO	MAX. FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO					
E-B	-192 / 0	0.0	0.0	0.10 (4)	7.81			
A-B	0 / 30	-77.4	-77.4	0.09 (1)	10.00			
B-C	-11 / 0	-77.4	-77.4	0.04 (1)	6.25			
E-D	0 / 0	-18.2	-18.2	0.13 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
DL =	3.0	PSF	
BOT CH.	LL =	0.0	PSF
DL =	7.3	PSF	
TOTAL LOAD =	33.6	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/999 (0.03")

CSI: TC=0.10/1.00 (B-E:4), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.08/1.00 (D-E:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES			
PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	
		MAX MIN	MAX MIN
MT20	618	354	1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.13 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



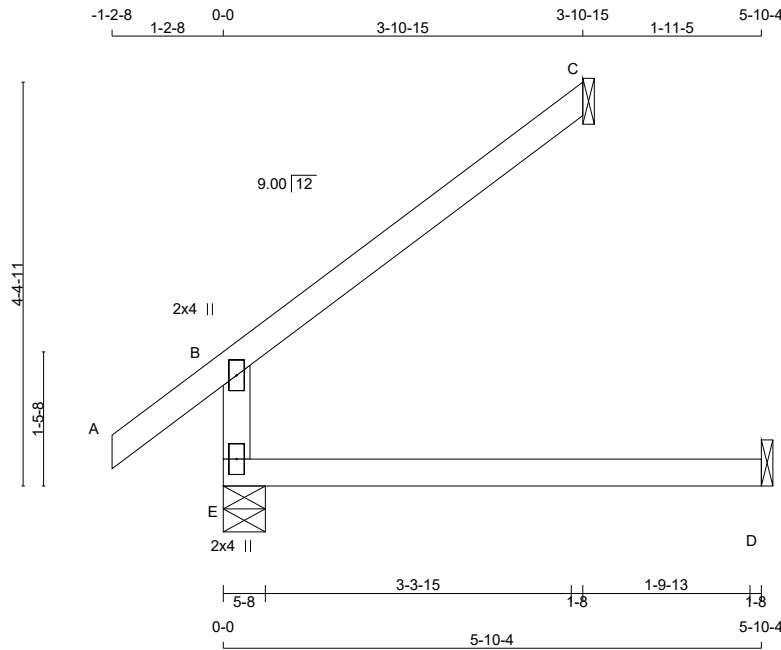

Scale = 1:25.1

TOTAL WEIGHT = 15 lb [M][F]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	SPF
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	2.0	4.0
E	BMV1+p	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG		REQRD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
E	351	0	351	0	0	5-8	5-8	5-8	5-8
C	114	0	114	0	0	1-8	1-8	1-8	1-8
D	45	0	50	0	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C , D

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS					DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	WIND	WIND		
E	246	174 / 0	0 / 0	0 / 0	0 / 0	72 / 0	0 / 0	72 / 0	0 / 0
C	77	68 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0	9 / 0	0 / 0
D	36	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED				WEBS		FACTORED	
	MAX. FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX	UNBRAC LENGTH	FR-TO	MAX. FORCE (LBS)	MAX	CS1 (LC)	CS1 (LC)
FR-TO		FROM	TO							
E-B	-289 / 0	0.0	0.0	0.10 (4)	7.81					
A-B	0 / 30	-77.4	-77.4	0.09 (1)	10.00					
B-C	-23 / 0	-77.4	-77.4	0.15 (1)	6.25					
E-D	0 / 0	-18.2	-18.2	0.13 (4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.3	PSF
TOTAL LOAD	=	33.6	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.03")

CSI: TC=0.15/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES				
PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	(PLI)
			MAX MIN	MAX MIN
MT20	618	354	1667	822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.20 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
NE0518-221	J08	1	1	GREEN YORK HOMES - GRANELLI HOME COPR - AMELIA 1 ELE 1	PAGE 22 OF 42

ID:JiDzXONJoFa2AxdT?3zOcwzBMzn-k6PReudncbjdPXoQVHmp5iydnU2qfZ1?k3nPEKzAy6E

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu May 31 15:50:07 2018 Page 1

Scale = 1:17.6

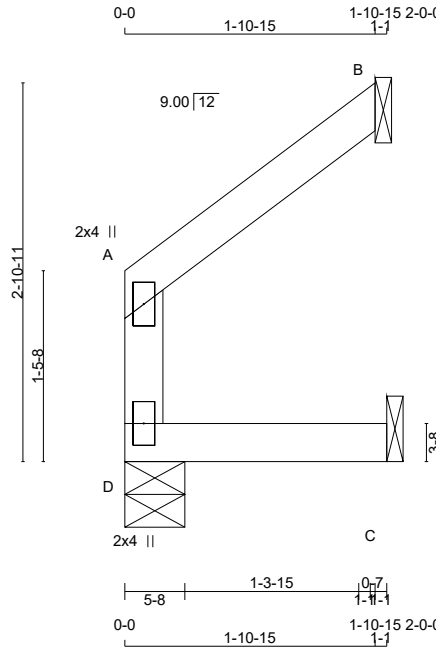

TOTAL WEIGHT = 6 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	SPF
D - A	2x4	DRY	No.2	SPF
A - B	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN
A	TMV+p	MT20	2.0	4.0
D	BMV1+p	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	UP
D	92	0	92	0
B	70	0	70	0
C	22	0	22	0

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) B , C

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. SNOW	MAX./MIN. LIVE	MAX./MIN. PERM. LIVE	MAX./MIN. WIND	MAX./MIN. DEAD	MAX./MIN. SOIL
D	65	45/0	0/0	0/0	0/0	20/0	0/0
B	47	41/0	0/0	0/0	0/0	6/0	0/0
C	17	3/0	0/0	0/0	0/0	14/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	MAX. LENGTH FR-TO
FR-TO		FROM	TO	FR-TO		FROM	TO
D-A	-78/0	0.0	0.0 0.01 (1)	7.81			
A-B	-3/0	-77.4	-77.4 0.04 (1)	10.00			
D-C	0/0	-18.2	-18.2 0.02 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.3	PSF
TOTAL LOAD	=	33.6	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.00")

CSI: TC=0.04/1.00 (A-B:1) , BC=0.02/1.00 (C-D:4) , WB=0.00/1.00 (n/a:0) , SSI=0.05/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES			
PLATE	GRIP(DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.05 (A) (INPUT = 0.90)
JSI METAL= 0.02 (A) (INPUT = 1.00)




READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
NE0518-221	J09	1	1	GREEN YORK HOMES - GRANELLI HOME COPR - AMELIA 1 ELE 1	PAGE 23 OF 42

ID:JiDzXONJoFa2AxdT?3zOcwzBMzn-k6PReudncbjdPXoQVHmp5iyb8U1pfZ1?k3nPEKzAy6E

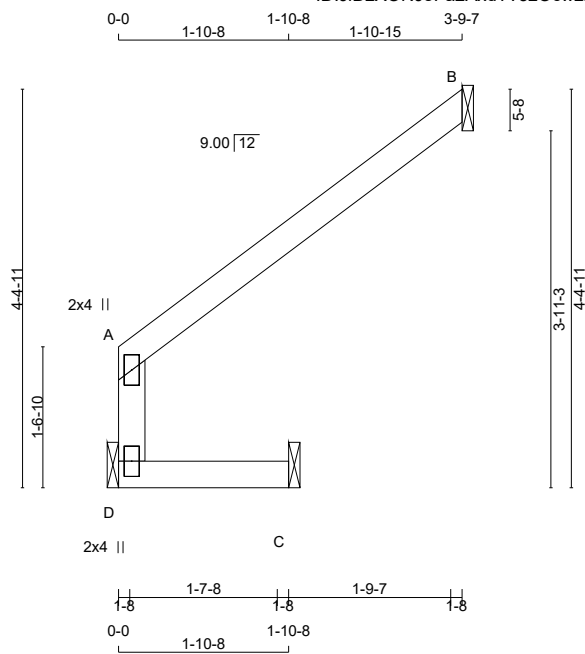

Scale = 1:25.4

TOTAL WEIGHT = 9 lb
[M][F]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	SPF
D - A	2x4	DRY	No.2	SPF
A - B	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMV+p	MT20	2.0	4.0
D	BMV1+p	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX
D	147	0	147	0	0	1-8	1-8	1-8
B	130	0	130	0	0	1-8	1-8	1-8
C	50	0	50	0	0	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) D , B , C

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
D	102	78 / 0	0 / 0	0 / 0	0 / 0	24 / 0	0 / 0
B	88	78 / 0	0 / 0	0 / 0	0 / 0	10 / 0	0 / 0
C	36	20 / 0	0 / 0	0 / 0	0 / 0	16 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED	FACTORED	MAX. FACTORED	FACTORED
	FORCE	VERT. LOAD	FORCE	FORCE
	(LBS)	(PLF)	(LBS)	(LBS)
FR-TO		FROM TO	LENGTH	FR-TO
D-A	-163 / 0	0.0 0.0 0.07 (1)	7.81	
A-B	-10 / 0	-77.4 -77.4 0.14 (1)	10.00	
D-C	0 / 0	-18.2 -18.2 0.08 (1)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.3	PSF
TOTAL LOAD	=	33.6	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.00")

CSI: TC=0.14/1.00 (A-B:1) , BC=0.08/1.00 (C-D:1) , WB=0.00/1.00 (n/a:0) , SSI=0.10/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.11 (A) (INPUT = 0.90)
JSI METAL= 0.04 (A) (INPUT = 1.00)




READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
NE0518-221	J10	7	1	GREEN YORK HOMES - GRANELLI HOME COPR - AMELIA 1 ELE 1	PAGE 24 OF 42

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu May 31 15:50:08 2018 Page 1
ID:JiDzXONJoFa2AxdT?3zOcwzBMzn-CJyprEePNurU1hNc3_t2dwVjuMsO?G8ziWymzmAy6D

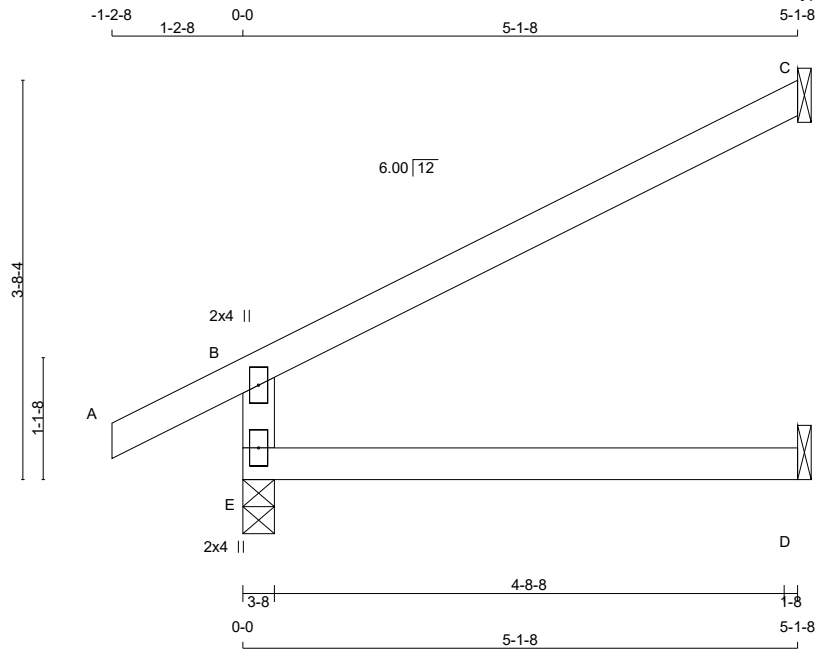

Scale = 1:21.3

TOTAL WEIGHT = 7 X 15 = 104 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	SPF
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	2.0	4.0
E	BMV1+p	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
E	401	0	401	0	3-8	3-8
C	149	0	149	0	1-8	1-8
D	39	0	44	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
E	279	208 / 0	0 / 0	0 / 0	0 / 0	71 / 0	0 / 0
C	101	90 / 0	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0
D	31	0 / 0	0 / 0	0 / 0	0 / 0	31 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)
FR-TO		FROM TO		FROM TO
E-B	-346 / 0	0.0 0.0 0.10 (4)	7.81	
A-B	0 / 22	-77.4 -77.4 0.09 (1)	10.00	
B-C	-22 / 0	-77.4 -77.4 0.35 (1)	6.25	
E-D	0 / 0	-18.2 -18.2 0.10 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.3	PSF
TOTAL LOAD	=	33.6	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= L/999 (0.02")

CSI: TC=0.35/1.00 (B-C:1), BC=0.10/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES	PLATE GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.20 (B) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu May 31 15:50:09 2018 Page 1
ID:JiDzXONJoFa2AxdT?3zOcwzBMzn-qVWB3af18CzLerypdIPA71v9lc27JPHBMGWJCzAy6C

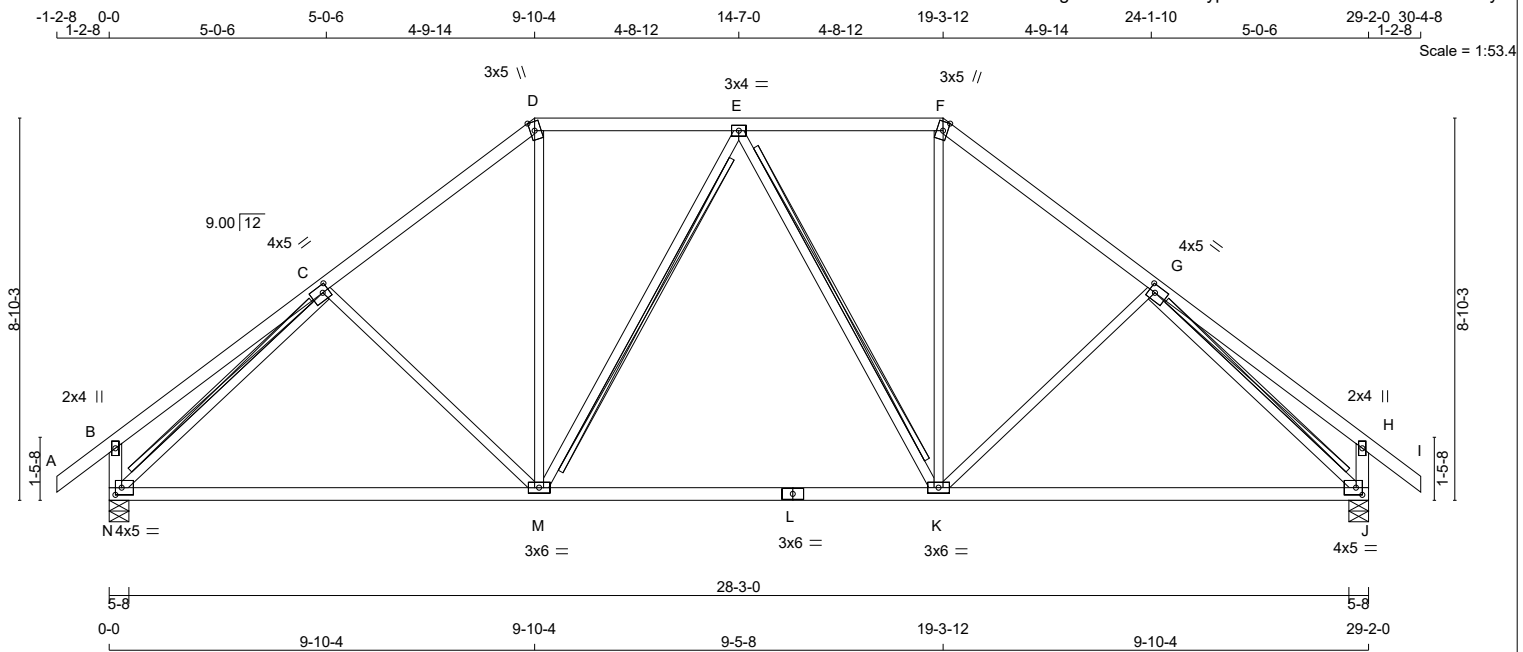

TOTAL WEIGHT = 2 X 129 = 257 lb

LUMBER

COMBINDER

N. L. G. A. RULES

CHORDS	SIZE		LUMBER	DESCR
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
N - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
N - L	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF

ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
--------------------	-----	-----	------	-----

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0	
C	TMWV-t	MT20	4.0	5.0	2.00 1.75
D	TTW+m	MT20	3.0	5.0	Edge 1.25
E	TMWV-t	MT20	3.0	4.0	
F	TTW+m	MT20	3.0	5.0	Edge 1.25
G	TMWV-t	MT20	4.0	5.0	2.00 1.75
H	TMV+p	MT20	2.0	4.0	
J	BMVW1-t	MT20	4.0	5.0	2.00 1.75
K	BMWVWV-t	MT20	3.0	6.0	
L	BS-t	MT20	3.0	6.0	
M	BMWVWV-t	MT20	3.0	6.0	
N	BMVW1-t	MT20	4.0	5.0	2.00 1.75

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.



DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
N	1495	0	1495	0	0	5-8	5-8
J	1495	0	1495	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
N	1048	740 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0
J	1048	740 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.26 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT E-M, E-K, C-N, G-J

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

C H O R D S					W E B S				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX CSI (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM	TO		LENGTH	FR-TO			
A-B	0 / 30	-77.4	-77.4	0.09 (1)	10.00	C-M	-160 / 20	0.15 (1)	
B-C	0 / 27	-77.4	-77.4	0.30 (1)	10.00	M-D	0 / 524	0.12 (1)	
C-D	-1381 / 0	-77.4	-77.4	0.26 (1)	5.26	M-E	-252 / 0	0.20 (1)	
D-E	-1088 / 0	-77.4	-77.4	0.23 (1)	5.79	E-K	-252 / 0	0.20 (1)	
E-F	-1088 / 0	-77.4	-77.4	0.23 (1)	5.79	K-F	0 / 524	0.12 (1)	
F-G	-1381 / 0	-77.4	-77.4	0.26 (1)	5.26	K-G	-160 / 20	0.15 (1)	
G-H	0 / 27	-77.4	-77.4	0.30 (1)	10.00	N-C	-1678 / 0	0.58 (1)	
H-I	0 / 30	-77.4	-77.4	0.09 (1)	10.00	G-J	-1678 / 0	0.58 (1)	
N-B	-246 / 0	0.0	0.0	0.03 (1)	7.81				
J-H	-246 / 0	0.0	0.0	0.03 (1)	7.81				
N-M	0 / 1198	-18.2	-18.2	0.48 (4)	10.00				
M-L	0 / 1208	-18.2	-18.2	0.48 (4)	10.00				
L-K	0 / 1208	-18.2	-18.2	0.48 (4)	10.00				
K-J	0 / 1198	-18.2	-18.2	0.48 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP	CH.	LL =	23.3	PSF
		DL =	3.0	PSF
BOT	CH.	LL =	0.0	PSF
		DL =	7.3	PSF
TOTAL LOAD		=	33.6	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A
SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.06")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.29")

CSI: TC=0.30/1.00 (G-H:1) , BC=0.48/1.00 (K-M:4) ,
WB=0.58/1.00 (G-J:1) , SSI=0.18/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (J) (INPUT = 0.90)
JSI METAL= 0.49 (C) (INPUT = 1.00)

**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



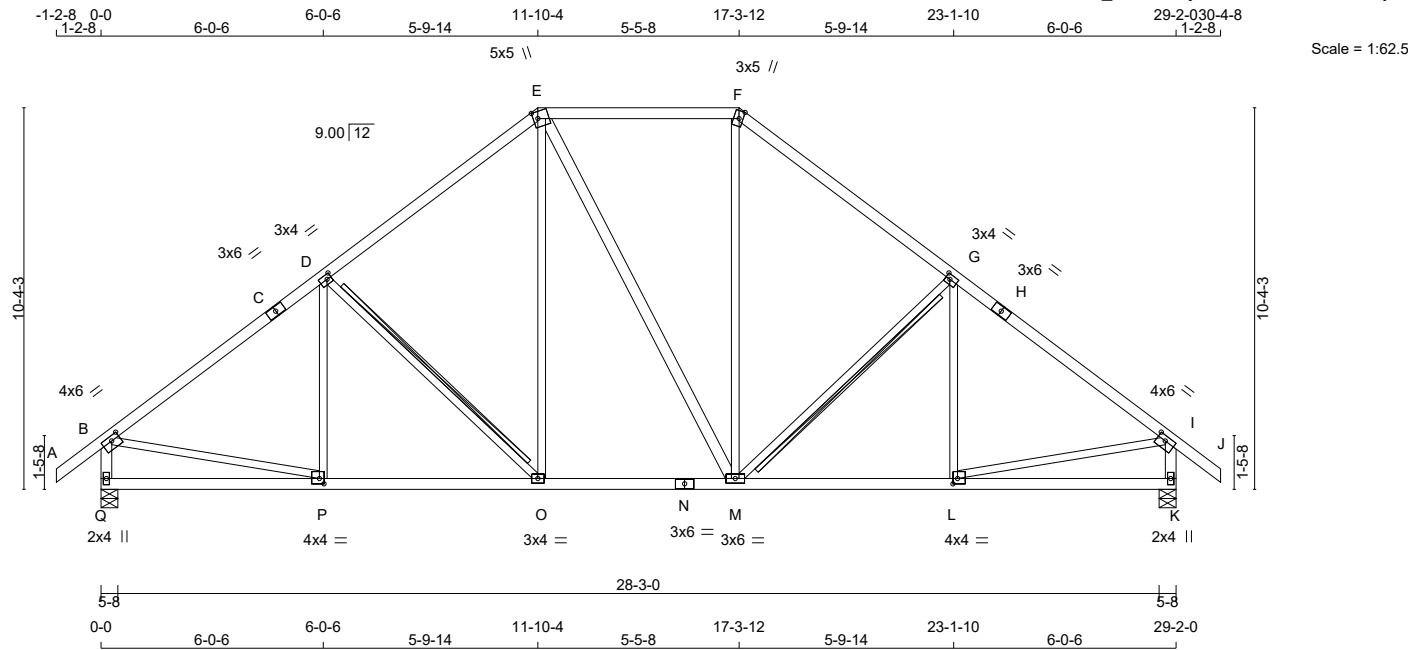

TOTAL WEIGHT = 139 lb
[M][F]

LUMBER				
N. L. G. A. RULES				
CHORDS		SIZE	LUMBER	DESCR
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - J	2x4	DRY	No.2	SPF
Q - B	2x4	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF
Q - N	2x4	DRY	No.2	SPF
N - K	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
E - M	2x4	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	4.0	6.0	1.50 2.75
C	TS-t	MT20	3.0	6.0	
D	TMWW-t	MT20	3.0	4.0	1.50 1.50
E	TTWW+m	MT20	5.0	5.0	2.25 1.50
F	TTW+m	MT20	3.0	5.0	Edge 1.25
G	TMWW-t	MT20	3.0	4.0	1.50 1.50
H	TS-t	MT20	3.0	6.0	
I	TMVW-t	MT20	4.0	6.0	1.50 2.75
K	BMV1+p	MT20	2.0	4.0	
L	BMWW-t	MT20	4.0	4.0	1.75 1.50
M	BMWWW-t	MT20	3.0	6.0	
N	BS-t	MT20	3.0	6.0	
O	BMWW-t	MT20	3.0	4.0	
P	BMWW-t	MT20	4.0	4.0	1.75 1.50
Q	BMV1+p	MT20	2.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
Q	1495	0	1495	0	0
K	1495	0	1495	0	0

UNFACTORED REACTIONS		1ST LCASE	MAX./MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
Q	1048	740 / 0	0 / 0
K	1048	740 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.88 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT D-O, G-M

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH
FR-TO		FROM TO	CSI (LC)	FR-TO		FROM TO	CSI (LC)
A-B	0 / 30	-77.4 -77.4	0.09 (1)	10.00	P-D	-112 / 69	0.06 (1)
B-C	-1528 / 0	-77.4 -77.4	0.42 (1)	4.88	D-O	-374 / 0	0.19 (1)
C-D	-1528 / 0	-77.4 -77.4	0.42 (1)	4.88	O-E	0 / 356	0.08 (1)
D-E	-1259 / 0	-77.4 -77.4	0.38 (1)	5.29	E-M	0 / 1	0.00 (1)
E-F	-982 / 0	-77.4 -77.4	0.31 (1)	5.90	M-F	0 / 357	0.08 (1)
F-G	-1259 / 0	-77.4 -77.4	0.38 (1)	5.29	M-G	-373 / 0	0.19 (1)
G-H	-1528 / 0	-77.4 -77.4	0.42 (1)	4.88	L-G	-113 / 69	0.06 (1)
H-I	-1528 / 0	-77.4 -77.4	0.42 (1)	4.88	B-P	0 / 1270	0.29 (1)
I-J	0 / 30	-77.4 -77.4	0.09 (1)	10.00	L-I	0 / 1270	0.29 (1)
Q-B	-1449 / 0	0.0 0.0	0.15 (1)	6.79			
K-I	-1449 / 0	0.0 0.0	0.15 (1)	6.79			
Q-P	0 / 0	-18.2 -18.2	0.16 (4)	10.00			
P-O	0 / 1249	-18.2 -18.2	0.28 (1)	10.00			
O-N	0 / 982	-18.2 -18.2	0.22 (1)	10.00			
N-M	0 / 982	-18.2 -18.2	0.22 (1)	10.00			
M-L	0 / 1248	-18.2 -18.2	0.28 (1)	10.00			
L-K	0 / 0	-18.2 -18.2	0.16 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL)= L/999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL)= L/999 (0.10")

CSI: TC=0.42/1.00 (B-D:1), BC=0.28/1.00 (O-P:1), WB=0.29/1.00 (B-P:1), SSI=0.18/1.00 (G-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (M) (INPUT = 0.90)
JSI METAL= 0.47 (P) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



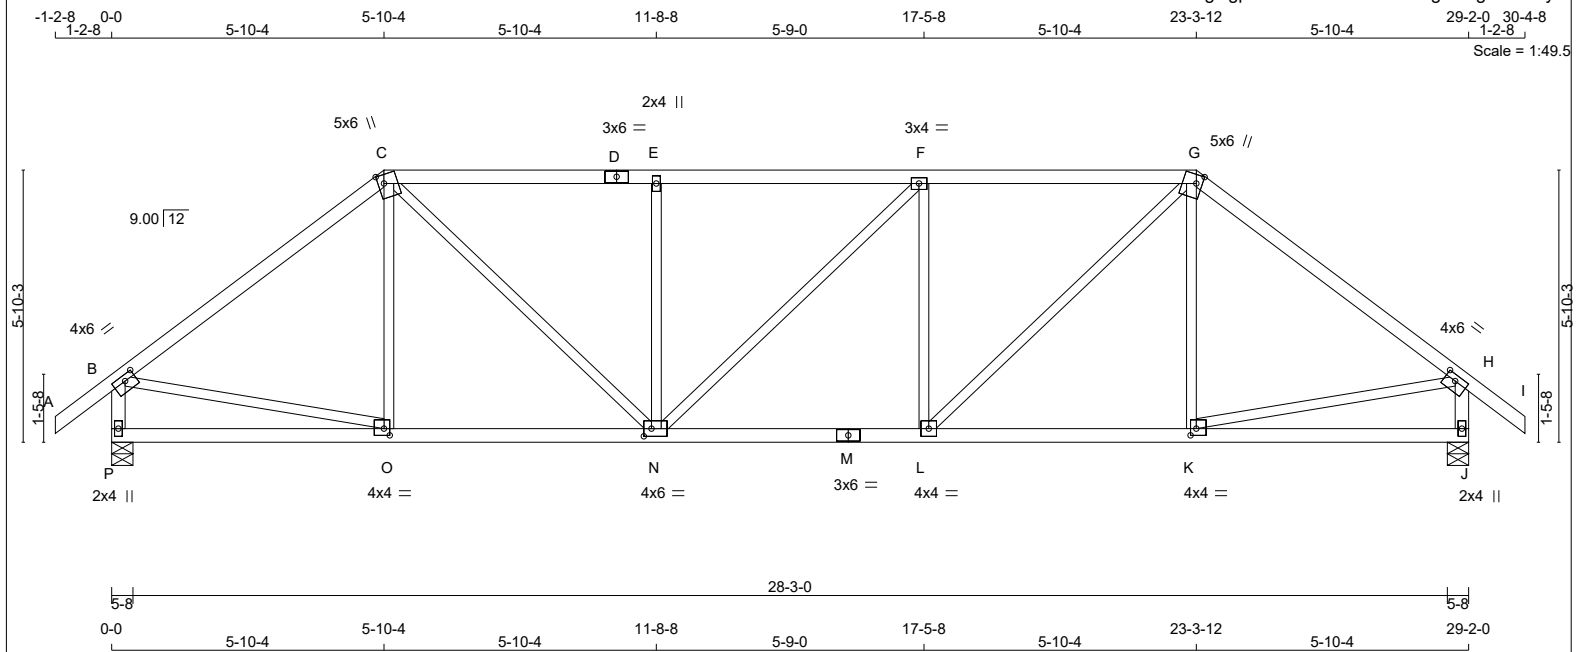

TOTAL WEIGHT = 121 lb [M]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
P - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
P - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
DRY: SEASONED LUMBER.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y
B	TMVW-t	MT20	4.0	6.0	1.50
C	TTWW+m	MT20	5.0	6.0	2.25
D	TS-t	MT20	3.0	6.0	
E	TMW+w	MT20	2.0	4.0	
F	TMWW-t	MT20	3.0	4.0	
G	TTWW+m	MT20	5.0	6.0	2.25
H	TMVW-t	MT20	4.0	6.0	1.50
J	BMV1+p	MT20	2.0	4.0	
K	BMWW-t	MT20	4.0	4.0	1.75
L	BMWW-t	MT20	4.0	4.0	
M	BS-t	MT20	3.0	6.0	
N	BMWWW-t	MT20	4.0	6.0	2.00
O	BMWW-t	MT20	4.0	4.0	1.75
P	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	IN-SX
P	1495	0	1495	0	0	5-8	5-8	5-8	5-8
J	1495	0	1495	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
P	1048	740 / 0	0 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0
J	1048	740 / 0	0 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.49 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC1)	UNBRACED LENGTH (FT)
FR-TO				FR-TO			
A-B	0 / 30	-77.4	-77.4 0.09 (1)	O-C	-104 / 66	0.05 (1)	10.00
B-C	-1493 / 0	-77.4	-77.4 0.59 (1)	C-N	0 / 852	0.19 (1)	4.68
C-D	-1810 / 0	-77.4	-77.4 0.44 (1)	N-E	-484 / 0	0.25 (1)	4.51
D-E	-1810 / 0	-77.4	-77.4 0.44 (1)	E-F	-2 / 0	0.00 (1)	4.51
E-F	-1809 / 0	-77.4	-77.4 0.44 (1)	F-G	-486 / 0	0.26 (1)	4.50
F-G	-1811 / 0	-77.4	-77.4 0.45 (1)	G-H	0 / 855	0.19 (1)	4.49
G-H	-1493 / 0	-77.4	-77.4 0.59 (1)	H-I	-105 / 66	0.06 (1)	4.68
H-I	0 / 30	-77.4	-77.4 0.09 (1)	I-J	0 / 1214	0.27 (1)	10.00
P-B	-1451 / 0	0.0	0.0 0.15 (1)	J-K	0 / 1213	0.27 (1)	6.79
J-H	-1451 / 0	0.0	0.0 0.15 (1)				6.79
P-O	0 / 0	-18.2	-18.2 0.15 (4)				10.00
O-N	0 / 1190	-18.2	-18.2 0.28 (1)				10.00
N-M	0 / 1811	-18.2	-18.2 0.35 (1)				10.00
M-L	0 / 1811	-18.2	-18.2 0.35 (1)				10.00
L-K	0 / 1190	-18.2	-18.2 0.28 (1)				10.00
K-J	0 / 0	-18.2	-18.2 0.15 (4)				10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.08")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.15")

CSI: TC=0.59/1.00 (B-C:1), BC=0.35/1.00 (L-N:1), WB=0.27/1.00 (B-O:1), SSI=0.21/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (G) (INPUT = 0.90)
JSI METAL= 0.50 (M) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



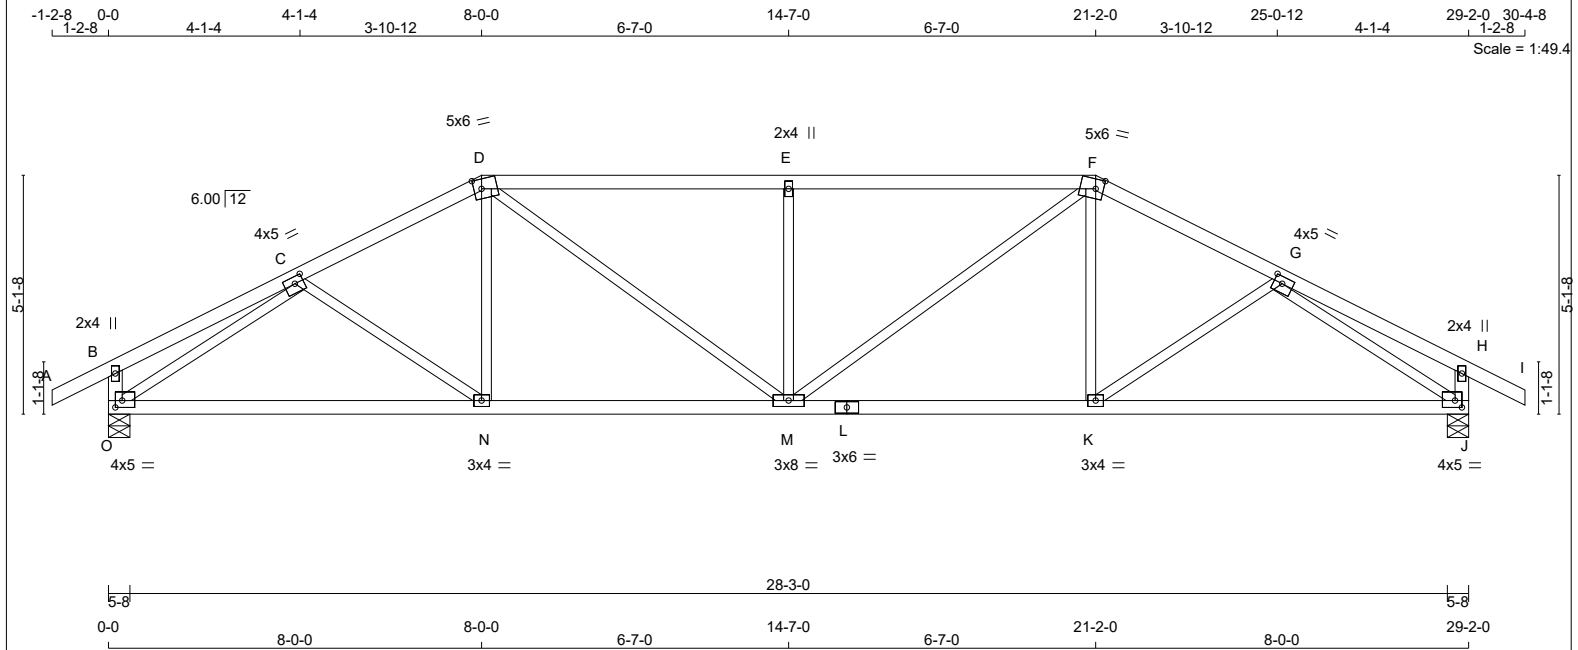

TOTAL WEIGHT = 112 lb
[M][F]

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
O - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
O - L	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
C	TMWW-t	MT20	4.0	5.0	1.75	2.25
D	TTWW-m	MT20	5.0	6.0	2.50	2.00
E	TMW+w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	6.0	2.50	2.00
G	TMWW-t	MT20	4.0	5.0	1.75	2.25
H	TMV+p	MT20	2.0	4.0		
J	BMVW1-t	MT20	4.0	5.0	1.75	1.75
K	BMWW-t	MT20	3.0	4.0		
L	BS-t	MT20	3.0	6.0		
M	BMWW-t	MT20	3.0	8.0		
N	BMWW-t	MT20	3.0	4.0		
O	BMVW1-t	MT20	4.0	5.0	1.75	1.75

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
O	1493	0	1493	0	5-8	5-8
J	1493	0	1493	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS				SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	
O	1047	739 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0
J	1047	739 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.07 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		MAX. UNBRAC LENGTH	MEMB.	WEBS		MAX. UNBRAC LENGTH
	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX. (LC)			MAX. FACTORED FORCE (LBS)	MAX. (LC)	
FR-TO		FROM	TO			FR-TO			
A-B	0 / 22	-77.4	-77.4	0.09 (1)	10.00	C-N	-27 / 60	0.02 (4)	
B-C	0 / 14	-77.4	-77.4	0.17 (1)	10.00	N-D	0 / 174	0.05 (4)	
C-D	-1914 / 0	-77.4	-77.4	0.18 (1)	4.72	D-M	0 / 608	0.14 (1)	
D-E	-2192 / 0	-77.4	-77.4	0.52 (1)	4.07	M-E	-626 / 0	0.24 (1)	
E-F	-2192 / 0	-77.4	-77.4	0.52 (1)	4.07	M-F	0 / 608	0.14 (1)	
F-G	-1914 / 0	-77.4	-77.4	0.18 (1)	4.72	K-F	0 / 174	0.05 (4)	
G-H	0 / 14	-77.4	-77.4	0.17 (1)	10.00	K-G	-27 / 60	0.02 (4)	
H-I	0 / 22	-77.4	-77.4	0.09 (1)	10.00	O-C	-2103 / 0	0.82 (1)	
O-B	-223 / 0	0.0	0.0	0.02 (1)	7.81	G-J	-2103 / 0	0.82 (1)	
J-H	-223 / 0	0.0	0.0	0.02 (1)	7.81				
O-N	0 / 1720	-18.2	-18.2	0.42 (1)	10.00				
N-M	0 / 1702	-18.2	-18.2	0.42 (1)	10.00				
M-L	0 / 1702	-18.2	-18.2	0.42 (1)	10.00				
L-K	0 / 1702	-18.2	-18.2	0.42 (1)	10.00				
K-J	0 / 1720	-18.2	-18.2	0.42 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:				
TOP	CH.	LL	=	23.3 PSF
		DL	=	3.0 PSF
BOT	CH.	LL	=	0.0 PSF
		DL	=	7.3 PSF
TOTAL LOAD			=	33.6 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.11")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.19")

CSI: TC=0.52/1.00 (E-F:1), BC=0.42/1.00 (J-K:1),
WB=0.82/1.00 (G-J:1), SSI=0.25/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667
		822	2284
			1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (F) (INPUT = 0.90)
JSI METAL= 0.62 (C) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



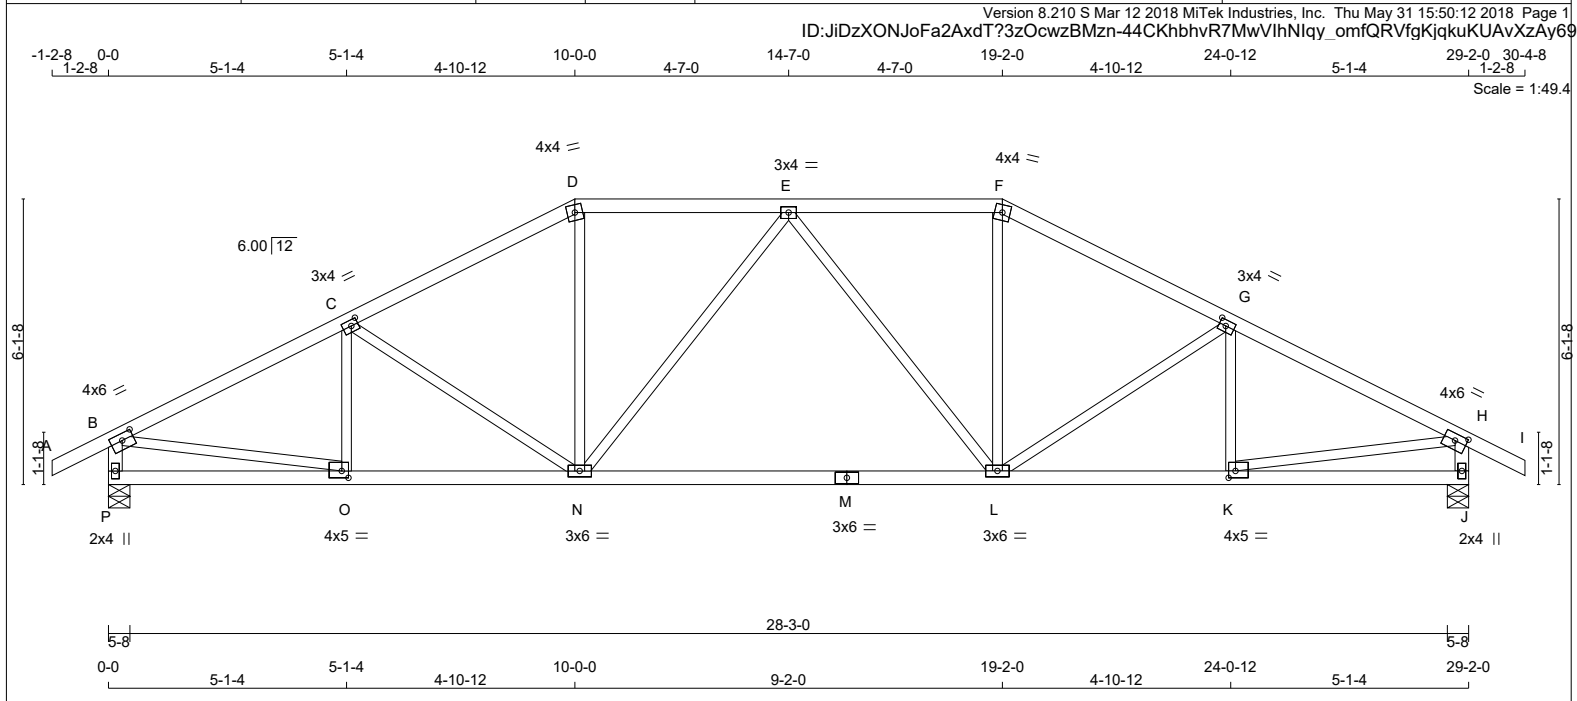


										TOTAL WEIGHT = 117 lb																																		
LUMBER N. L. G. A. RULES					DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										DESIGN CRITERIA																													
CHORDS SIZE					LUMBER					DESCR.					BEARINGS																													
A - D 2x4 DRY No.2 SPF										FACTORED					MAXIMUM FACTORED					INPUT					REQRD																			
D - F 2x4 DRY No.2 SPF										GROSS REACTION					GROSS REACTION					BRG					BRG																			
F - I 2x4 DRY No.2 SPF										JT VERT HORZ					DOWN HORZ UPLIFT					IN-SX					IN-SX																			
P - B 2x4 DRY No.2 SPF										P 1493 0 1493 0 0					5-8					5-8																								
J - H 2x4 DRY No.2 SPF										J 1493 0 1493 0 0					5-8					5-8																								
P - M 2x4 DRY No.2 SPF																																												
M - J 2x4 DRY No.2 SPF																																												
ALL WEBS 2x3 DRY No.2 SPF										UNFACTORED REACTIONS																																		
EXCEPT										1ST LCASE					MAX./MIN. COMPONENT REACTIONS																													
										JT COMBINED					SNOW					LIVE					PERM.LIVE					WIND					DEAD					SOIL				
										P 1047					739 / 0					0 / 0					0 / 0					0 / 0					308 / 0					0 / 0				
										J 1047					739 / 0					0 / 0					0 / 0					0 / 0					308 / 0					0 / 0				
DRY: SEASONED LUMBER.																														LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM														

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J							THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010																																																																																																																																																						
BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.51 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.							THIS DESIGN COMPLIES WITH: - PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014 - CSA 086-09 - TPIC 2011																																																																																																																																																						
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.							(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD																																																																																																																																																						
LOADING TOTAL LOAD CASES: (4)							ALLOWABLE DEFL.(LL)= L/360 (0.97") CALCULATED VERT. DEFL.(LL) = L/ 999 (0.09") ALLOWABLE DEFL.(TL)= L/360 (0.97") CALCULATED VERT. DEFL.(TL)= L/ 999 (0.25")																																																																																																																																																						
<table><tr><th colspan="4">CHORDS</th><th colspan="4">WEBS</th></tr><tr><th>MEMB.</th><th>MAX. FACTORED FORCE (LBS)</th><th>FACTORED VERT. LOAD (PLF)</th><th>MAX. FACTORED VERT. LOAD (LC1)</th><th>MAX. UNBRACED CSI (LC)</th><th>MEMB.</th><th>MAX. FACTORED FORCE (LBS)</th><th>MAX. UNBRACED CSI (LC)</th></tr><tr><td>FR-TO</td><td></td><td>FROM</td><td>TO</td><td>LENGTH</td><td>FR-TO</td><td></td><td></td></tr><tr><td>A- B</td><td>0 / 22</td><td>-77.4</td><td>-77.4</td><td>0.09 (1)</td><td>10.00</td><td>O- C</td><td>-213 / 7</td></tr><tr><td>B- C</td><td>-2006 / 0</td><td>-77.4</td><td>-77.4</td><td>0.30 (1)</td><td>4.51</td><td>C- N</td><td>-272 / 0</td></tr><tr><td>C- D</td><td>-1795 / 0</td><td>-77.4</td><td>-77.4</td><td>0.28 (1)</td><td>4.73</td><td>N- D</td><td>0 / 512</td></tr><tr><td>D- E</td><td>-1595 / 0</td><td>-77.4</td><td>-77.4</td><td>0.23 (1)</td><td>5.00</td><td>N- E</td><td>-272 / 0</td></tr><tr><td>E- F</td><td>-1595 / 0</td><td>-77.4</td><td>-77.4</td><td>0.23 (1)</td><td>5.00</td><td>E- L</td><td>-272 / 0</td></tr><tr><td>F- G</td><td>-1795 / 0</td><td>-77.4</td><td>-77.4</td><td>0.28 (1)</td><td>4.73</td><td>L- F</td><td>0 / 512</td></tr><tr><td>G- H</td><td>-2006 / 0</td><td>-77.4</td><td>-77.4</td><td>0.30 (1)</td><td>4.51</td><td>L- G</td><td>-272 / 0</td></tr><tr><td>H- I</td><td>0 / 22</td><td>-77.4</td><td>-77.4</td><td>0.09 (1)</td><td>10.00</td><td>K- G</td><td>-213 / 7</td></tr><tr><td>P- B</td><td>-1448 / 0</td><td>0.0</td><td>0.0</td><td>0.15 (1)</td><td>6.79</td><td>B- O</td><td>0 / 1834</td></tr><tr><td>J- H</td><td>-1448 / 0</td><td>0.0</td><td>0.0</td><td>0.15 (1)</td><td>6.79</td><td>K- H</td><td>0 / 1834</td></tr><tr><td>P- O</td><td>0 / 0</td><td>-18.2</td><td>-18.2</td><td>0.11 (4)</td><td>10.00</td><td></td><td></td></tr><tr><td>O- N</td><td>0 / 1811</td><td>-18.2</td><td>-18.2</td><td>0.42 (1)</td><td>10.00</td><td></td><td></td></tr><tr><td>N- M</td><td>0 / 1761</td><td>-18.2</td><td>-18.2</td><td>0.42 (1)</td><td>10.00</td><td></td><td></td></tr><tr><td>M- L</td><td>0 / 1761</td><td>-18.2</td><td>-18.2</td><td>0.42 (1)</td><td>10.00</td><td></td><td></td></tr><tr><td>L- K</td><td>0 / 1811</td><td>-18.2</td><td>-18.2</td><td>0.42 (1)</td><td>10.00</td><td></td><td></td></tr></table>							CHORDS				WEBS				MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. UNBRACED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED CSI (LC)	FR-TO		FROM	TO	LENGTH	FR-TO			A- B	0 / 22	-77.4	-77.4	0.09 (1)	10.00	O- C	-213 / 7	B- C	-2006 / 0	-77.4	-77.4	0.30 (1)	4.51	C- N	-272 / 0	C- D	-1795 / 0	-77.4	-77.4	0.28 (1)	4.73	N- D	0 / 512	D- E	-1595 / 0	-77.4	-77.4	0.23 (1)	5.00	N- E	-272 / 0	E- F	-1595 / 0	-77.4	-77.4	0.23 (1)	5.00	E- L	-272 / 0	F- G	-1795 / 0	-77.4	-77.4	0.28 (1)	4.73	L- F	0 / 512	G- H	-2006 / 0	-77.4	-77.4	0.30 (1)	4.51	L- G	-272 / 0	H- I	0 / 22	-77.4	-77.4	0.09 (1)	10.00	K- G	-213 / 7	P- B	-1448 / 0	0.0	0.0	0.15 (1)	6.79	B- O	0 / 1834	J- H	-1448 / 0	0.0	0.0	0.15 (1)	6.79	K- H	0 / 1834	P- O	0 / 0	-18.2	-18.2	0.11 (4)	10.00			O- N	0 / 1811	-18.2	-18.2	0.42 (1)	10.00			N- M	0 / 1761	-18.2	-18.2	0.42 (1)	10.00			M- L	0 / 1761	-18.2	-18.2	0.42 (1)	10.00			L- K	0 / 1811	-18.2	-18.2	0.42 (1)	10.00			CSI: TC=0.30/1.00 (G-H:1) , BC=0.42/1.00 (K-L:1) , WB=0.41/1.00 (H-K:1) , SSI=0.17/1.00 (D-E:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10 COMPANION LIVE LOAD FACTOR = 0.50						
CHORDS				WEBS																																																																																																																																																									
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. UNBRACED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED CSI (LC)																																																																																																																																																						
FR-TO		FROM	TO	LENGTH	FR-TO																																																																																																																																																								
A- B	0 / 22	-77.4	-77.4	0.09 (1)	10.00	O- C	-213 / 7																																																																																																																																																						
B- C	-2006 / 0	-77.4	-77.4	0.30 (1)	4.51	C- N	-272 / 0																																																																																																																																																						
C- D	-1795 / 0	-77.4	-77.4	0.28 (1)	4.73	N- D	0 / 512																																																																																																																																																						
D- E	-1595 / 0	-77.4	-77.4	0.23 (1)	5.00	N- E	-272 / 0																																																																																																																																																						
E- F	-1595 / 0	-77.4	-77.4	0.23 (1)	5.00	E- L	-272 / 0																																																																																																																																																						
F- G	-1795 / 0	-77.4	-77.4	0.28 (1)	4.73	L- F	0 / 512																																																																																																																																																						
G- H	-2006 / 0	-77.4	-77.4	0.30 (1)	4.51	L- G	-272 / 0																																																																																																																																																						
H- I	0 / 22	-77.4	-77.4	0.09 (1)	10.00	K- G	-213 / 7																																																																																																																																																						
P- B	-1448 / 0	0.0	0.0	0.15 (1)	6.79	B- O	0 / 1834																																																																																																																																																						
J- H	-1448 / 0	0.0	0.0	0.15 (1)	6.79	K- H	0 / 1834																																																																																																																																																						
P- O	0 / 0	-18.2	-18.2	0.11 (4)	10.00																																																																																																																																																								
O- N	0 / 1811	-18.2	-18.2	0.42 (1)	10.00																																																																																																																																																								
N- M	0 / 1761	-18.2	-18.2	0.42 (1)	10.00																																																																																																																																																								
M- L	0 / 1761	-18.2	-18.2	0.42 (1)	10.00																																																																																																																																																								
L- K	0 / 1811	-18.2	-18.2	0.42 (1)	10.00																																																																																																																																																								
PLATES (table is in inches) <table><tr><th>JT</th><th>TYPE</th><th>PLATES</th><th>W</th><th>LEN</th><th>Y</th><th>X</th></tr><tr><td>B</td><td>TMVW-t</td><td>MT20</td><td>4.0</td><td>6.0</td><td>1.75</td><td>3.00</td></tr><tr><td>C</td><td>TMWW-t</td><td>MT20</td><td>3.0</td><td>4.0</td><td>1.50</td><td>1.75</td></tr><tr><td>D</td><td>TTW-m</td><td>MT20</td><td>4.0</td><td>4.0</td><td></td><td></td></tr><tr><td>E</td><td>TMWW-t</td><td>MT20</td><td>3.0</td><td>4.0</td><td></td><td></td></tr><tr><td>F</td><td>TTW-m</td><td>MT20</td><td>4.0</td><td>4.0</td><td></td><td></td></tr><tr><td>G</td><td>TMWW-t</td><td>MT20</td><td>3.0</td><td>4.0</td><td>1.50</td><td>1.75</td></tr><tr><td>H</td><td>TMVW-t</td><td>MT20</td><td>4.0</td><td>6.0</td><td>1.75</td><td>3.00</td></tr><tr><td>J</td><td>BMV1+p</td><td>MT20</td><td>2.0</td><td>4.0</td><td></td><td></td></tr><tr><td>K</td><td>BMWW-t</td><td>MT20</td><td>4.0</td><td>5.0</td><td>1.75</td><td>1.75</td></tr><tr><td>L</td><td>BMWW-t</td><td>MT20</td><td>3.0</td><td>6.0</td><td></td><td></td></tr><tr><td>M</td><td>BS-t</td><td>MT20</td><td>3.0</td><td>6.0</td><td></td><td></td></tr><tr><td>N</td><td>BMWW-t</td><td>MT20</td><td>3.0</td><td>6.0</td><td></td><td></td></tr><tr><td>O</td><td>BMWW-t</td><td>MT20</td><td>4.0</td><td>5.0</td><td>1.75</td><td>1.75</td></tr><tr><td>P</td><td>BMV1+p</td><td>MT20</td><td>2.0</td><td>4.0</td><td></td><td></td></tr></table>							JT	TYPE	PLATES	W	LEN	Y	X	B	TMVW-t	MT20	4.0	6.0	1.75	3.00	C	TMWW-t	MT20	3.0	4.0	1.50	1.75	D	TTW-m	MT20	4.0	4.0			E	TMWW-t	MT20	3.0	4.0			F	TTW-m	MT20	4.0	4.0			G	TMWW-t	MT20	3.0	4.0	1.50	1.75	H	TMVW-t	MT20	4.0	6.0	1.75	3.00	J	BMV1+p	MT20	2.0	4.0			K	BMWW-t	MT20	4.0	5.0	1.75	1.75	L	BMWW-t	MT20	3.0	6.0			M	BS-t	MT20	3.0	6.0			N	BMWW-t	MT20	3.0	6.0			O	BMWW-t	MT20	4.0	5.0	1.75	1.75	P	BMV1+p	MT20	2.0	4.0			TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT . NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION																																													
JT	TYPE	PLATES	W	LEN	Y	X																																																																																																																																																							
B	TMVW-t	MT20	4.0	6.0	1.75	3.00																																																																																																																																																							
C	TMWW-t	MT20	3.0	4.0	1.50	1.75																																																																																																																																																							
D	TTW-m	MT20	4.0	4.0																																																																																																																																																									
E	TMWW-t	MT20	3.0	4.0																																																																																																																																																									
F	TTW-m	MT20	4.0	4.0																																																																																																																																																									
G	TMWW-t	MT20	3.0	4.0	1.50	1.75																																																																																																																																																							
H	TMVW-t	MT20	4.0	6.0	1.75	3.00																																																																																																																																																							
J	BMV1+p	MT20	2.0	4.0																																																																																																																																																									
K	BMWW-t	MT20	4.0	5.0	1.75	1.75																																																																																																																																																							
L	BMWW-t	MT20	3.0	6.0																																																																																																																																																									
M	BS-t	MT20	3.0	6.0																																																																																																																																																									
N	BMWW-t	MT20	3.0	6.0																																																																																																																																																									
O	BMWW-t	MT20	4.0	5.0	1.75	1.75																																																																																																																																																							
P	BMV1+p	MT20	2.0	4.0																																																																																																																																																									

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

ID:JiDzXONJoFa2AxdT?3zOcwzBMzn-ZGmiuxiYCRUn7SGasXTDKzCZzv0q39Lt6 EjSzzAy68

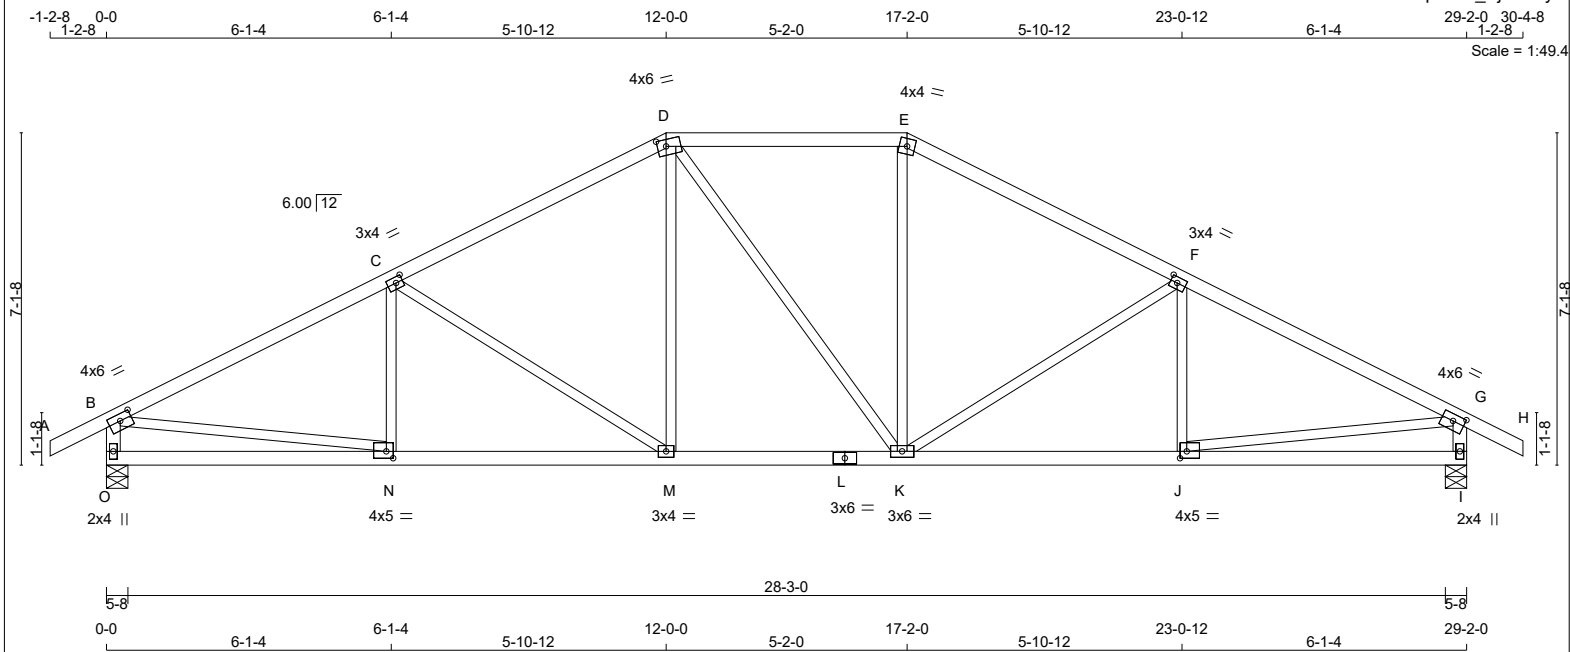

TOTAL WEIGHT = 118 lb

N. L. G. A.

N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR
A - D	2x4	DRY No.2	SPF
D - E	2x4	DRY No.2	SPF
E - H	2x4	DRY No.2	SPF
O - B	2x4	DRY No.2	SPF
I - G	2x4	DRY No.2	SPF
O - L	2x4	DRY No.2	SPF
L - I	2x4	DRY No.2	SPF

ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
--------------------	-----	-----	------	-----

DRY: SEASONED LUMBER.

PLATES (table is in inches)

J	T	TYPE	PLATES	W	LEN	Y	X
B	T	TMVW-t	MT20	4.0	6.0	1.75	3.00
C	T	TMVW-t	MT20	3.0	4.0	1.50	1.75
D	T	TTWV-m	MT20	4.0	6.0	1.75	2.25
E	F	TTW-m	MT20	4.0	4.0		
F	T	TMVW-t	MT20	3.0	4.0	1.50	1.75
G	T	TMVW-t	MT20	4.0	6.0	1.75	3.00
H	J	BMV1+p	MT20	2.0	4.0		
I	J	BMVW-t	MT20	4.0	5.0	1.75	1.75
J	K	BMVWVW-t	MT20	3.0	6.0		
K	L	BS-t	MT20	3.0	6.0		
L	M	BMVWVW-t	MT20	3.0	4.0		
M	N	BMVWVW-t	MT20	4.0	5.0	1.75	1.75
N	O	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
O	1493	0	1493	0	0	5-8	5-8
I	1493	0	1493	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
O	1047	739 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0
I	1047	739 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O. I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.33 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED			
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC	MEMB.	FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO		LENGTH	FR-TO		
A-B	0 / 22	-77.4	-77.4 0.09 (1)	10.00	N-C	-125 / 67	0.03 (1)
B-C	-2031 / 0	-77.4	-77.4 0.44 (1)	4.33	C-M	-469 / 0	0.46 (1)
C-D	-1641 / 0	-77.4	-77.4 0.40 (1)	4.75	M-D	0 / 351	0.08 (1)
D-E	-1450 / 0	-77.4	-77.4 0.29 (1)	5.11	D-K	0 / 0	0.00 (0)
E-F	-1641 / 0	-77.4	-77.4 0.40 (1)	4.75	K-E	0 / 352	0.08 (1)
F-G	-2031 / 0	-77.4	-77.4 0.44 (1)	4.33	K-F	-468 / 0	0.46 (1)
G-H	0 / 22	-77.4	-77.4 0.09 (1)	10.00	J-F	-126 / 67	0.03 (1)
O-B	-1446 / 0	0.0	0.0 0.15 (1)	6.80	B-N	0 / 1854	0.42 (1)
I-G	-1445 / 0	0.0	0.0 0.15 (1)	6.80	J-G	0 / 1854	0.42 (1)
O-N	0 / 0	-18.2	-18.2 0.16 (4)	10.00			
N-M	0 / 1838	-18.2	-18.2 0.37 (1)	10.00			
M-L	0 / 1450	-18.2	-18.2 0.29 (1)	10.00			
L-K	0 / 1450	-18.2	-18.2 0.29 (1)	10.00			
K-J	0 / 1838	-18.2	-18.2 0.36 (1)	10.00			
J-I	0 / 0	-18.2	-18.2 0.16 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP	CH.	LL	=	23.3	PSF
		DL	=	3.0	PSF
BOT	CH.	LL	=	0.0	PSF
		DL	=	7.3	PSF
TOTAL LOAD				=	33.6 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A
SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.09")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.16")

CSI: TC=0.44/1.00 (B-C:1) , BC=0.37/1.00 (M-N:1) ,
WB=0.46/1.00 (C-M:1) , SS=0.20/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES						
PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (B) (INPUT = 0.90)
JSI METAL= 0.55 (N) (INPUT = 1.00)



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



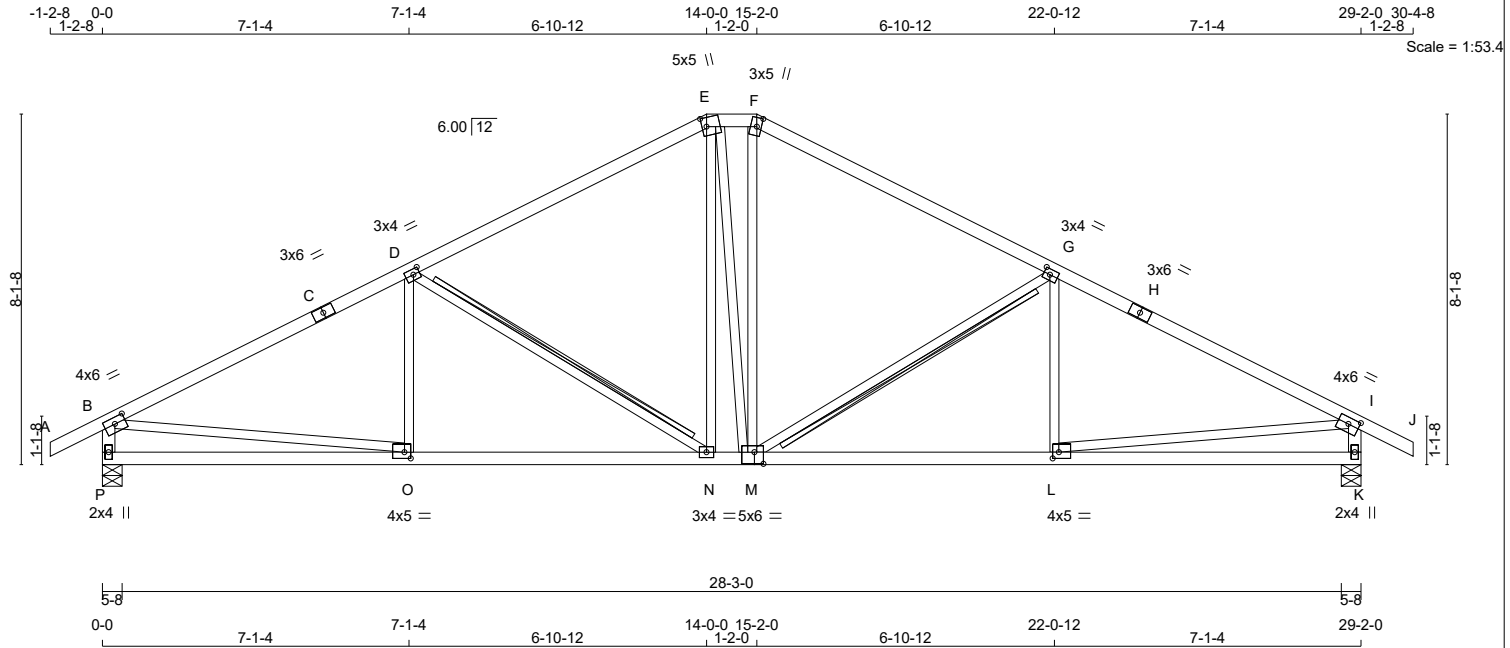

TOTAL WEIGHT = 124 lb [M][F]

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - E	2x4	DRY No.2	SPF
E - F	2x4	DRY No.2	SPF
F - H	2x4	DRY No.2	SPF
H - J	2x4	DRY No.2	SPF
P - B	2x4	DRY No.2	SPF
K - I	2x4	DRY No.2	SPF
P - M	2x4	DRY No.2	SPF
M - K	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	4.0	6.0	1.75 3.00
C	TS-t	MT20	3.0	6.0	
D	TMWW-t	MT20	3.0	4.0	1.50 1.75
E	TTWW+m	MT20	5.0	5.0	2.50 1.25
F	TTW+m	MT20	3.0	5.0	2.50 1.25
G	TMWW-t	MT20	3.0	4.0	1.50 1.75
H	TS-t	MT20	3.0	6.0	
I	TMVW-t	MT20	4.0	6.0	1.75 3.00
K	BMV1+p	MT20	2.0	4.0	
L	BMWW-t	MT20	4.0	5.0	1.75 1.75
N	BSWWW-I	MT20	5.0	6.0	3.25 2.50
M	BMWW-t	MT20	3.0	4.0	
O	BMWW-t	MT20	4.0	5.0	1.75 1.75
P	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	P	VERT	HORZ	DOWN	HORZ UPLIFT
P	K	1493	0	1493	0
K		1493	0	1493	0

UNFACTORED REACTIONS		1ST LCASE	MAX./MIN. COMPONENT REACTIONS	DEAD	SOIL
JT	P	COMBINED	SNOW	LIVE	PERM.LIVE
P	K	1047	739 / 0	0 / 0	0 / 0
K		1047	739 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.10 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT D-N, G-M

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING		CHORDS		WEBS	
TOTAL LOAD CASES: (4)		MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)
FR-TO			FROM TO	FR-TO	
A-B	0 / 22	-77.4	-77.4 0.09 (1)	O-D	-66 / 103
B-C	-2027 / 0	-77.4	-77.4 0.62 (1)	D-N	-637 / 0
C-D	-2027 / 0	-77.4	-77.4 0.62 (1)	N-E	0 / 378
D-E	-1481 / 0	-77.4	-77.4 0.55 (1)	E-M	0 / 27
E-F	-1306 / 0	-77.4	-77.4 0.03 (1)	M-F	0 / 406
F-G	-1485 / 0	-77.4	-77.4 0.55 (1)	G-H	-632 / 0
G-H	-2025 / 0	-77.4	-77.4 0.62 (1)	H-I	-71 / 101
H-I	-2025 / 0	-77.4	-77.4 0.62 (1)	I-J	0 / 1851
I-J	0 / 22	-77.4	-77.4 0.09 (1)	J-K	0 / 1849
P-B	-1440 / 0	0.0	0.0 0.15 (1)		
K-I	-1439 / 0	0.0	0.0 0.15 (1)		
P-O	0 / 0	-18.2	-18.2 0.22 (4)		
O-N	0 / 1838	-18.2	-18.2 0.41 (1)		
N-M	0 / 1303	-18.2	-18.2 0.31 (1)		
M-L	0 / 1837	-18.2	-18.2 0.40 (1)		
L-K	0 / 0	-18.2	-18.2 0.22 (4)		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL)= L/999 (0.09")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL)= L/999 (0.19")

CSI: TC=0.62/1.00 (B-D:1), BC=0.41/1.00 (N-O:1), WB=0.42/1.00 (B-O:1), SSI=0.24/1.00 (B-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.90 (B) (INPUT = 0.90)
JSI METAL= 0.55 (O) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



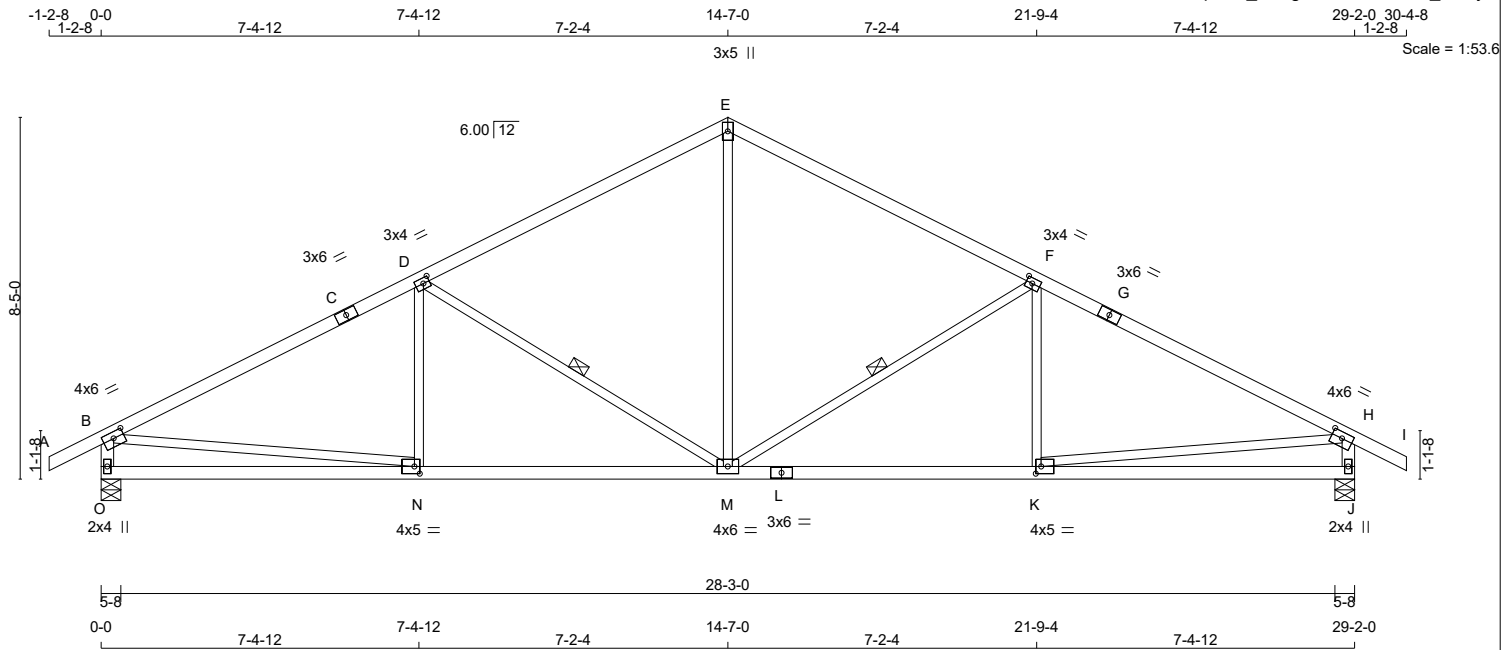

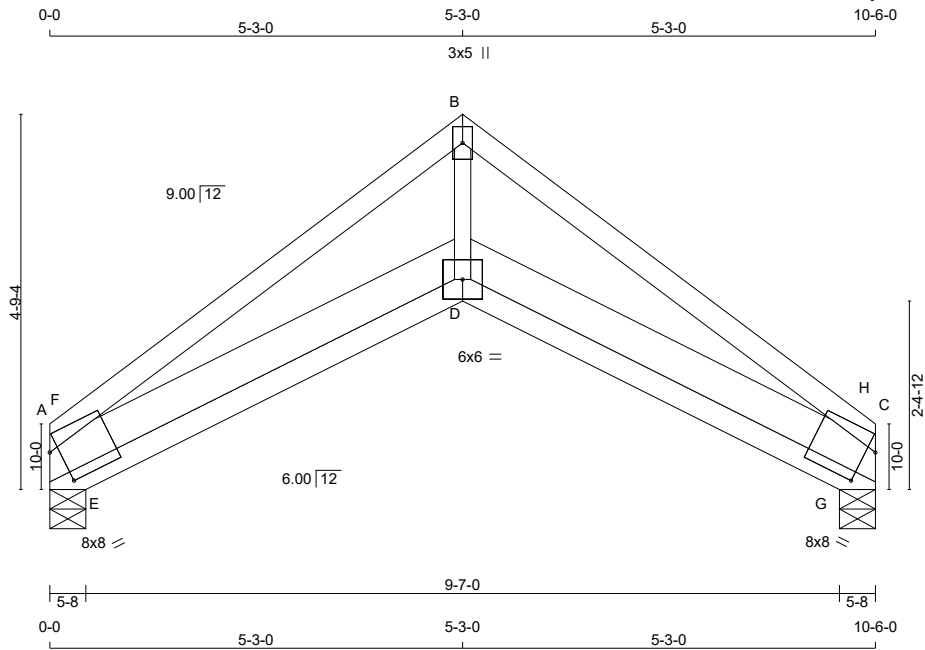

Scale = 1:29.3

TOTAL WEIGHT = 2 X 52 = 104 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	DRY	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF
B - C	2x4	DRY	No.2	SPF
A - D	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF
REINFORCING MEMBERS				
HW1	2x6	DRY	No.2	SPF
HW2	2x6	DRY	No.2	SPF
ALL WEBS 2x3 DRY: SEASONED LUMBER.				
			No.2	SPF

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMBMW1-I	MT20	8.0	8.0	5.50 1.50
B	TTW+p	MT20	3.0	5.0	
C	TMBMW1-I	MT20	8.0	8.0	5.50 1.50
D	BBWWW-p	MT20	6.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQRD
		GROSS REACTION	GROSS REACTION	BRG	BRG
JT		VERT	HORZ	DOWN	UPLIFT
A		502	0	502	0
C		502	0	502	0

UNFACTORED REACTIONS		1ST LCASE	MAX./MIN. COMPONENT REACTIONS				
JT		COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
A		353	245 / 0	0 / 0	0 / 0	0 / 0	108 / 0
C		353	245 / 0	0 / 0	0 / 0	0 / 0	108 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD	VERT. LOAD	MEMB.	FORCE
	(LBS)	(PLF)	(PLF)		(LBS)
FR-TO		FROM	TO	FR-TO	
A - F	-906 / 0	-77.4	-77.4	D - B	0 / 672
F - B	-833 / 0	-77.4	-77.4	E - F	0 / 169
B - H	-833 / 0	-77.4	-77.4	F - D	0 / 172
H - C	-906 / 0	-77.4	-77.4	G - H	0 / 169
				H - D	0 / 172
A - E	0 / 568	-18.2	-18.2		
E - D	0 / 541	-18.3	-18.3		
D - G	0 / 541	-18.2	-18.2		
G - C	0 / 568	-18.3	-18.3		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.21/1.00 (B-F:1), BC=0.15/1.00 (A-E:4), WB=0.15/1.00 (B-D:1), SSI=0.14/1.00 (B-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.44 (B) (INPUT = 0.90)
JSI METAL= 0.16 (A) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



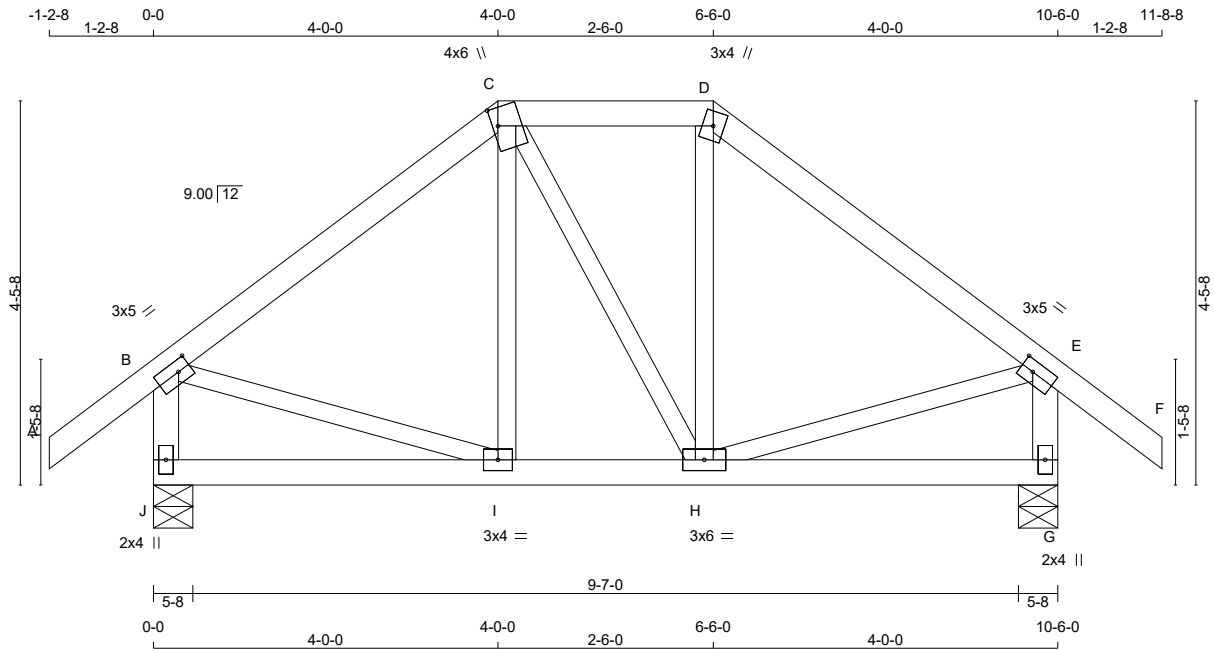

TOTAL WEIGHT = 49 lb
[M][F]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
J - B	2x4	DRY	No.2	SPF
G - E	2x4	DRY	No.2	SPF
J - G	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	3.0	5.0	1.50	1.75
C	TTWW+m	MT20	4.0	6.0	2.50	0.75
D	TTW+m	MT20	3.0	4.0		
E	TMVW-t	MT20	3.0	5.0	1.50	1.75
G	BMV1+p	MT20	2.0	4.0		
H	BMWW-t	MT20	3.0	6.0		
I	BMWW-t	MT20	3.0	4.0		
J	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
		GROSS REACTION		GROSS REACTION		BRG		BRG	
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
J		602	0	602	0	0	5-8	5-8	
G		602	0	602	0	0	5-8	5-8	

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	421	305 / 0	0 / 0	0 / 0	0 / 0	116 / 0	0 / 0
G	421	305 / 0	0 / 0	0 / 0	0 / 0	116 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. (PLF)	FACTORED LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. (PLF)	FACTORED LC1 MAX (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 30	-77.4	-77.4 0.09 (1)	10.00	I-C	-21 / 45	0.02 (4)
B-C	-383 / 0	-77.4	-77.4 0.16 (1)	6.25	C-H	0 / 0	0.00 (1)
C-D	-305 / 0	-77.4	-77.4 0.06 (1)	6.25	H-D	-21 / 45	0.02 (4)
D-E	-383 / 0	-77.4	-77.4 0.16 (1)	6.25	B-I	0 / 317	0.07 (1)
E-F	0 / 30	-77.4	-77.4 0.09 (1)	10.00	H-E	0 / 317	0.07 (1)
J-B	-570 / 0	0.0	0.0 0.06 (1)	7.81			
G-E	-570 / 0	0.0	0.0 0.06 (1)	7.81			
J-I	0 / 0	-18.2	-18.2 0.07 (4)	10.00			
I-H	0 / 305	-18.2	-18.2 0.08 (4)	10.00			
H-G	0 / 0	-18.2	-18.2 0.06 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.3	PSF
TOTAL LOAD	=	33.6	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.16/1.00 (B-C:1), BC=0.08/1.00 (H-I:4), WB=0.07/1.00 (B-I:1), SSI=0.10/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES		PLATE GRIP(DRY)		SHEAR		SECTION	
(PSI)	(PLI)	(PSI)	(PLI)	(PSI)	(PLI)	(PSI)	(PLI)
MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656	

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.59 (H) (INPUT = 0.90)
JSI METAL= 0.16 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



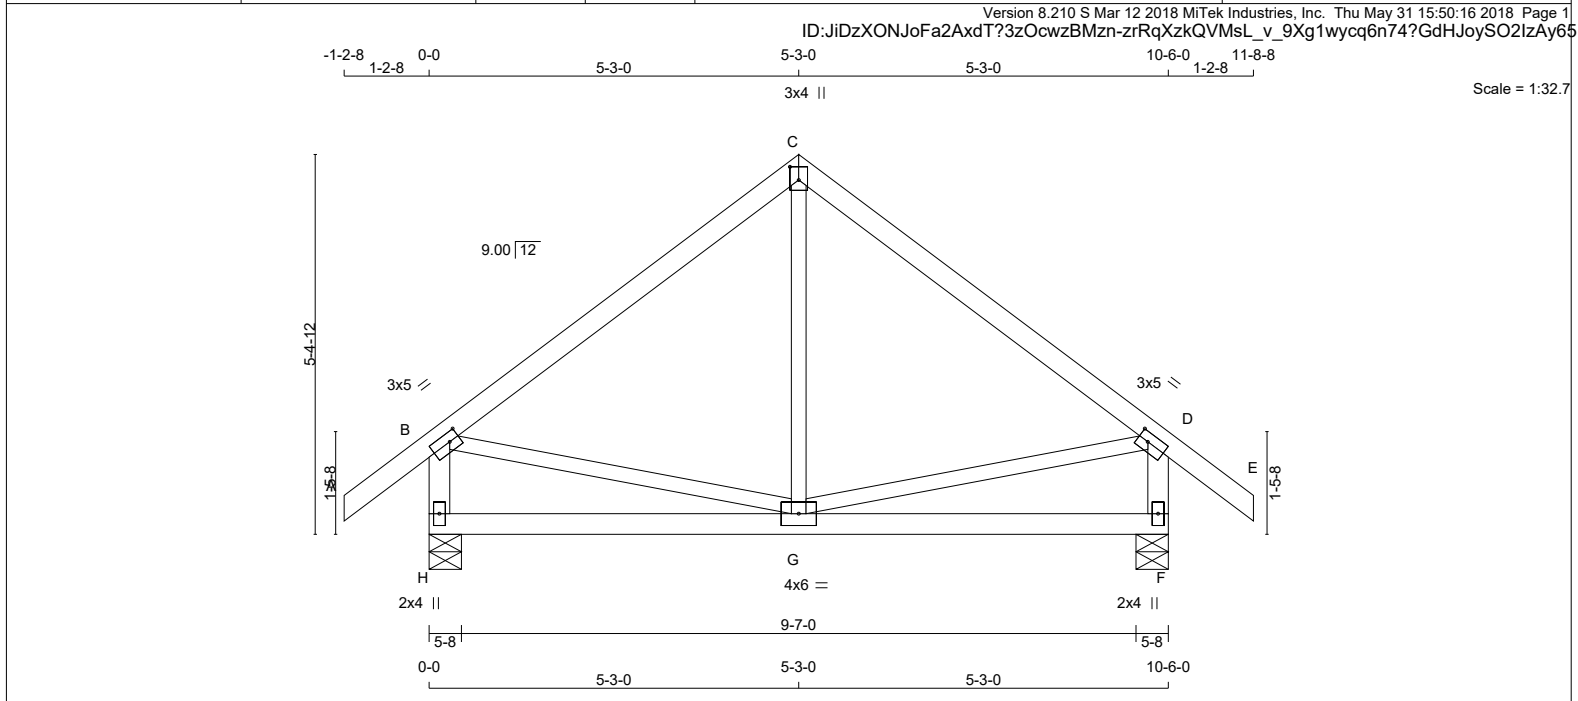

TOTAL WEIGHT = 45 lb
[M][F]

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
F - D	2x4	DRY	No.2
H - F	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DESCR.
SPF
SPF
SPF
SPF
SPF
SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	3.0	5.0	1.50	1.75
C	TTW+p	MT20	3.0	4.0	2.25	1.50
D	TMVW-t	MT20	3.0	5.0	1.50	1.75
F	BMV1+p	MT20	2.0	4.0		
G	BMVWW-t	MT20	4.0	6.0		
H	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
	VERT	HORZ	UPLIFT	IN-SX
JT				
H	602	0	0	5-8
F	602	0	0	5-8

UNFACTORED REACTIONS

	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	421	305 / 0	0 / 0	0 / 0	0 / 0	116 / 0	0 / 0
F	421	305 / 0	0 / 0	0 / 0	0 / 0	116 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)		
FR-TO		FROM TO			FR-TO				
A-B	0 / 30	-77.4 -77.4	0.09 (1)	10.00	G-C	0 / 94	0.03 (4)		
B-C	-339 / 0	-77.4 -77.4	0.27 (1)	6.25	B-G	0 / 278	0.06 (1)		
C-D	-339 / 0	-77.4 -77.4	0.27 (1)	6.25	G-D	0 / 278	0.06 (1)		
D-E	0 / 30	-77.4 -77.4	0.09 (1)	10.00					
H-B	-565 / 0	0.0 0.0	0.06 (1)	7.81					
F-D	-565 / 0	0.0 0.0	0.06 (1)	7.81					
H-G	0 / 0	-18.2 -18.2	0.14 (4)	10.00					
G-F	0 / 0	-18.2 -18.2	0.14 (4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:

TOP	CH.	LL	=	23.3	PSF
		DL	=	3.0	PSF
BOT	CH.	LL	=	0.0	PSF
		DL	=	7.3	PSF
TOTAL		LOAD	=	33.6	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.02")

CSI: TC=0.27/1.00 (B-C:1), BC=0.14/1.00 (F-G:4), WB=0.06/1.00 (B-G:1), SSI=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
	MAX	MIN	MAX MIN
MT20	618	354	1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.48 (B) (INPUT = 0.90)
JSI METAL= 0.16 (D) (INPUT = 1.00)




READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN YORK HOMES - GRANELLI HOME COPR - AMELIA 1 ELE 1	DRWG NO.
NE0518-221	T13	3	1	TRUSS DESC.		PAGE 37 OF 42

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu May 31 15:50:16 2018 Page 1
ID:JiDzXONJoFa2AxdT?3zOcwzBMzn-zrRqXzkQVMsL v 9Xg1wycg6n745GdKJoySO2IzAy65

Scale = 1:32.7

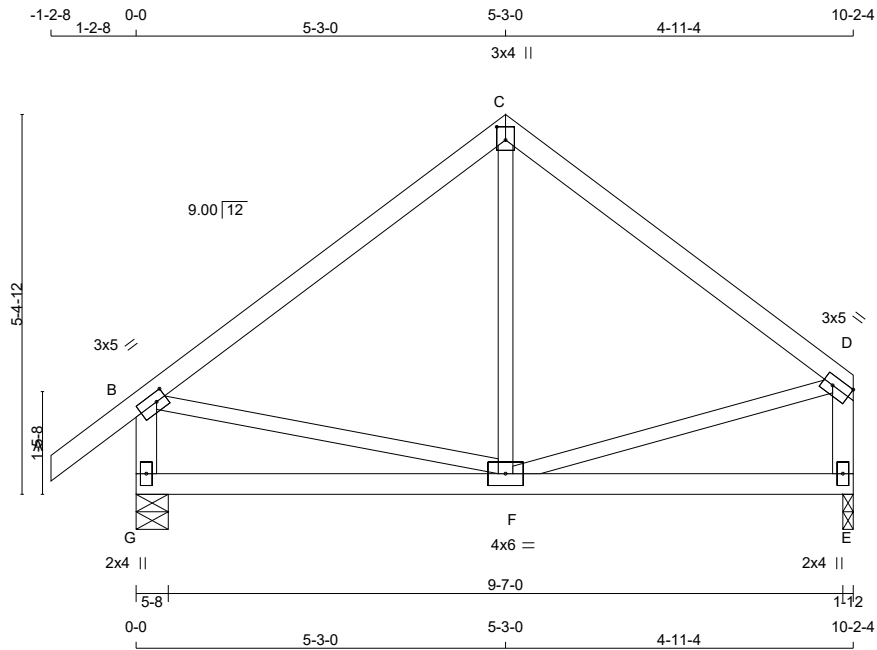

TOTAL WEIGHT = 3 X 43 = 128 lb

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR
A - C	2x4	DRY No.2	SPF
C - D	2x4	DRY No.2	SPF
G - B	2x4	DRY No.2	SPF
E - D	2x4	DRY No.2	SPF
G - E	2x4	DRY No.2	SPF

ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
--------------------	-----	-----	------	-----

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	3.0	5.0	1.50	1.75
C	TTW+p	MT20	3.0	4.0	2.25	1.50
D	TMVW-t	MT20	3.0	5.0	1.50	Edge
E	BMV1+p	MT20	2.0	4.0		
F	BMWWW-t	MT20	4.0	6.0		
G	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
G	587	0	587	0	0	5-8	5-8
E	487	0	487	0	0	1-12	1-12

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
G	410	298 / 0	0 / 0	0 / 0	0 / 0	113 / 0	0 / 0
E	342	237 / 0	0 / 0	0 / 0	0 / 0	105 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G, E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX FACTORED CSI (LC)		
FR-TO		FROM TO			FR-TO				
A - B	0 / 30	-77.4	-77.4	0.09 (1)	10.00	F - C	-11 / 87	0.03 (4)	
B - C	-319 / 0	-77.4	-77.4	0.27 (1)	6.25	B - F	0 / 261	0.06 (1)	
C - D	-319 / 0	-77.4	-77.4	0.24 (1)	6.25	F - D	0 / 265	0.06 (1)	
G - B	-548 / 0	0.0	0.0	0.06 (1)	7.81				
E - D	-456 / 0	0.0	0.0	0.05 (1)	7.81				
G - F	0 / 0	-18.2	-18.2	0.14 (4)	10.00				
F - E	0 / 0	-18.2	-18.2	0.14 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP	CH.	LL =	23.3	PSF
		DL =	3.0	PSF
BOT	CH.	LL =	0.0	PSF
		DL =	7.3	PSF
TOTAL LOAD		=	33.6	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.34")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.34")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.02")

CSI: TC=0.27/1.00 (B-C:1) , BC=0.14/1.00 (F-G:4) ,
WB=0.06/1.00 (D-F:1) , SSI=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES					
PLATE	GRIP(DRY)		SHEAR		SECTION
	(PSI)		(PLI)		(PLI)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	618	354	1667	822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.46 (B) (INPUT = 0.90)
JSI METAL= 0.15 (B) (INPUT = 1.00)



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



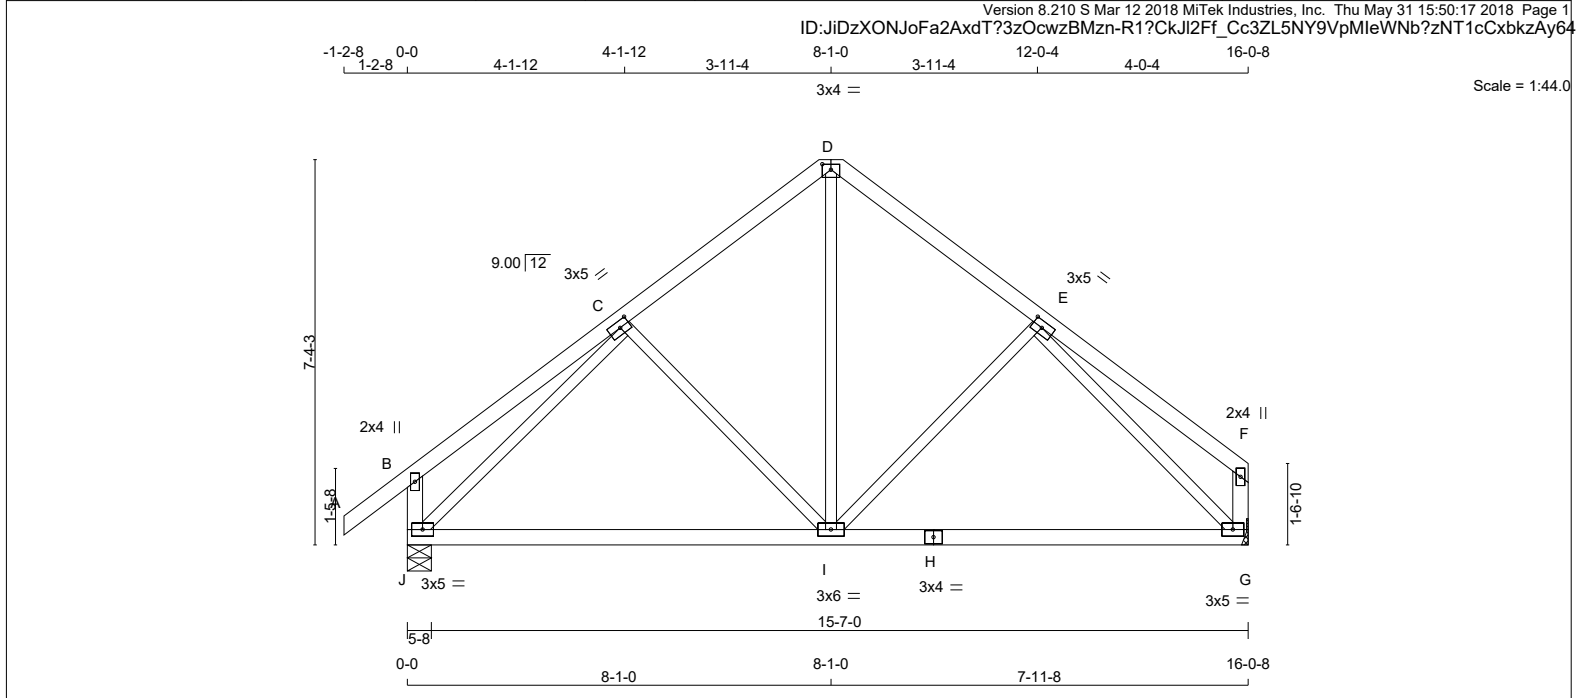

TOTAL WEIGHT = 69 lb

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
J - B	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
H - G	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 EXCEPT
SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
C	TMWW-t	MT20	3.0	5.0	1.50	2.25
D	TTW-p	MT20	3.0	4.0	1.25	2.00
E	TMWW-t	MT20	3.0	5.0	1.50	2.25
F	TMV+p	MT20	2.0	4.0		
G	BMVW1-t	MT20	3.0	5.0		
H	BS-t	MT20	3.0	4.0		
I	BMVWW-t	MT20	3.0	6.0		
J	BMVW1-t	MT20	3.0	5.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
J	867	0	867	0	5-8	5-8
G	767	0	767	0	MECHANICAL	

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT G TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS					SOIL
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	
J	607	434 / 0	0 / 0	0 / 0	0 / 0	173 / 0	0 / 0
G	539	374 / 0	0 / 0	0 / 0	0 / 0	165 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

MEMB.	CHORDS			MEMB.	WEBS		
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 30	-77.4	-77.4	0.09 (1)	C-I	-181 / 1	0.10 (1)
B-C	0 / 22	-77.4	-77.4	0.20 (1)	I-D	0 / 427	0.10 (1)
C-D	-580 / 0	-77.4	-77.4	0.16 (1)	I-E	-164 / 5	0.09 (1)
D-E	-580 / 0	-77.4	-77.4	0.15 (1)	J-C	-824 / 0	0.46 (1)
E-F	0 / 22	-77.4	-77.4	0.20 (1)	E-G	-820 / 0	0.44 (1)
J-B	-219 / 0	0.0	0.0	0.02 (1)			
G-F	-114 / 0	0.0	0.0	0.01 (1)			
J-I	0 / 574	-18.2	-18.2	0.38 (4)			
I-H	0 / 562	-18.2	-18.2	0.38 (4)			
H-G	0 / 562	-18.2	-18.2	0.38 (4)			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	PSF
DL	23.3	PSF
DL	3.0	PSF
BOT CH.	LL	PSF
DL	0.0	PSF
DL	7.3	PSF
TOTAL LOAD	33.6	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.53")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.53")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.10")

CSI: TC=0.20/1.00 (B-C:1), BC=0.38/1.00 (I-J:4), WB=0.46/1.00 (C-J:1), SSI=0.12/1.00 (I-J:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (I) (INPUT = 0.90)
JSI METAL= 0.24 (C) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



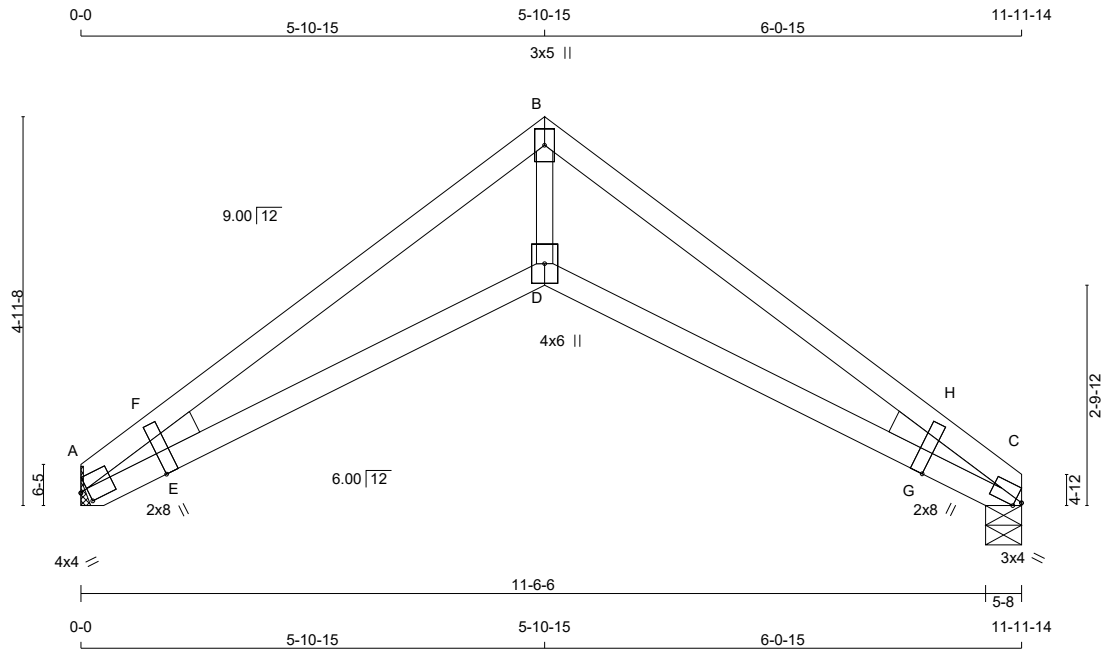

Scale = 1:29.4

TOTAL WEIGHT = 2 X 38 = 76 lb [M][F]

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF
B - C	2x4	DRY	No.2	SPF
A - D	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMB1-I	MT20	4.0	4.0	2.00	1.00
A	WP+I	MT20	2.0	8.0	Edge	13.00
B	TTW+p	MT20	3.0	5.0		
C	TMB1-I	MT20	3.0	4.0	Edge	1.00
C	WP+I	MT20	2.0	8.0	Edge	15.50
D	BBW+p	MT20	4.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG	HEEL WEDGE
	VERT	HORZ	DOWN	HORZ			
A	573	0	573	0	MECHANICAL		2x4 L
C	573	0	573	0	5-8	5-8	2x4 R

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT A TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
A	403	279 / 0	0 / 0	0 / 0	0 / 0	124 / 0	0 / 0
C	403	279 / 0	0 / 0	0 / 0	0 / 0	124 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.49 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX FACTORED CSI (LC)		
FR-TO		FROM TO			FR-TO				
A-F	-1332 / 0	-77.4 -77.4	0.11 (1)	5.52	D-B	0 / 1079	0.24 (1)		
F-B	-1202 / 0	-77.4 -77.4	0.28 (1)	5.52	E-F	-29 / 78	0.00 (1)		
B-H	-1199 / 0	-77.4 -77.4	0.31 (1)	5.49	G-H	-60 / 66	0.00 (1)		
H-C	-1312 / 0	-77.4 -77.4	0.07 (1)	5.58					
A-E	0 / 1035	-18.3 -18.3	0.26 (1)	10.00					
E-D	0 / 1072	-18.2 -18.2	0.30 (1)	10.00					
D-G	0 / 1076	-18.2 -18.2	0.34 (1)	10.00					
G-C	0 / 1025	-18.2 -18.2	0.31 (1)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.3	PSF
TOTAL LOAD		=	33.6	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.40")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL)= L/360 (0.40")
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.31/1.00 (B-H:1) , BC=0.34/1.00 (D-G:1) , WB=0.24/1.00 (B-D:1) , SSI=0.13/1.00 (B-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.72 (D) (INPUT = 0.90)
JSI METAL= 0.45 (A) (INPUT = 1.00)




READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
NE0518-221	T16	1	1	GREEN YORK HOMES - GRANELLI HOME COPR - AMELIA 1 ELE 1	PAGE 40 OF 42

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu May 31 15:50:18 2018 Page 1
ID:JiDzXONJoFa2AxdT?3zOcwzBMzn-vEZbyfmg0z63DD8Xe53O11vT9wkWkT?cGGxU7BzAy63

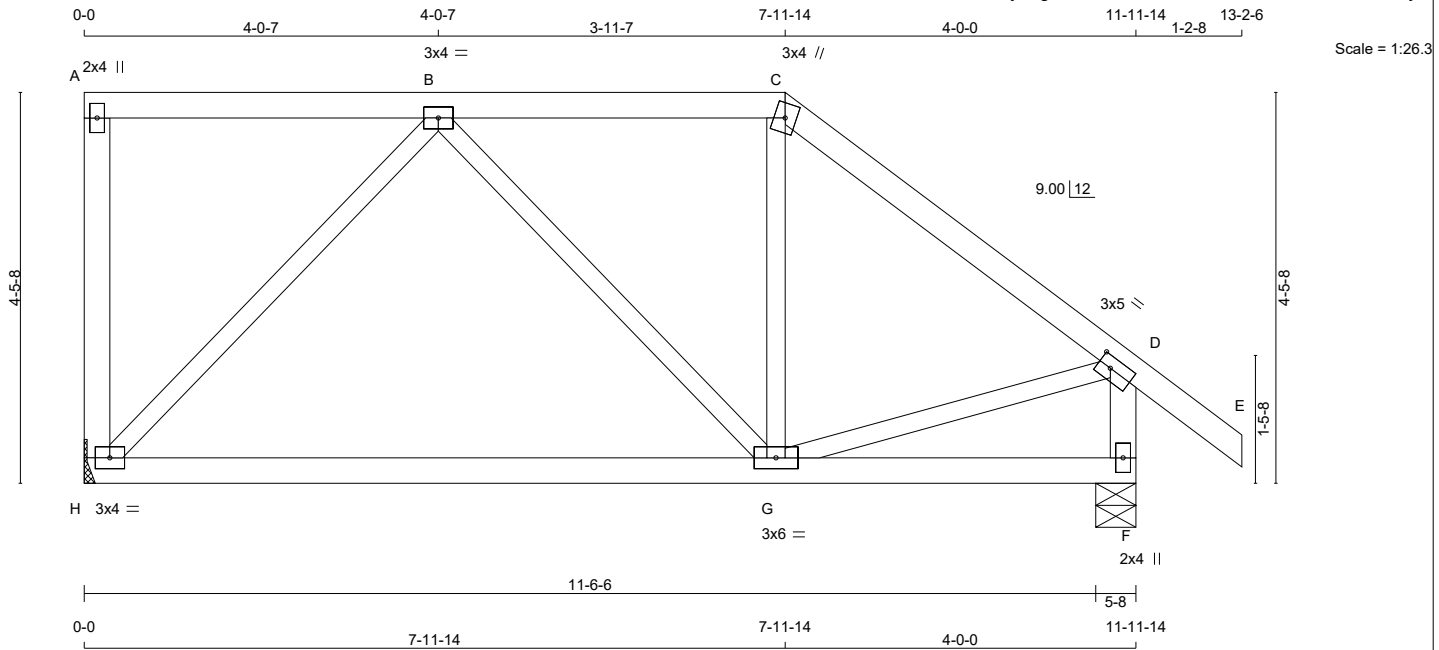

TOTAL WEIGHT = 51 lb [M]

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
H - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
F - D	2x4	DRY	No.2
H - F	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMV+p	MT20	2.0	4.0	
B	TMWW-t	MT20	3.0	4.0	
C	TTW+m	MT20	3.0	4.0	
D	TMVW-t	MT20	3.0	5.0	1.50 1.75
F	BMV1+p	MT20	2.0	4.0	
G	BMWW-t	MT20	3.0	6.0	
H	BMVW1-t	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQRD
JT	GROSS REACTION	GROSS REACTION	DOWN	UP	BRG
H	573	0	573	0	MECHANICAL
F	674	0	674	0	5-8

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT H TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	403	279 / 0	0 / 0	0 / 0	0 / 0	124 / 0	0 / 0
F	471	340 / 0	0 / 0	0 / 0	0 / 0	131 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	
FR-TO		FROM	TO	FR-TO			
H-A	-119 / 0	0.0	0.0 0.04 (1)	G-C	0 / 75	0.03 (4)	
A-B	0 / 0	-77.4	-77.4 0.20 (1)	G-D	0 / 409	0.09 (1)	
B-C	-394 / 0	-77.4	-77.4 0.21 (1)	H-B	-550 / 0	0.30 (1)	
C-D	-494 / 0	-77.4	-77.4 0.22 (1)	B-G	0 / 73	0.03 (4)	
D-E	0 / 30	-77.4	-77.4 0.09 (1)				
F-D	-661 / 0	0.0	0.0 0.07 (1)				
H-G	0 / 383	-18.2	-18.2 0.27 (4)				
G-F	0 / 0	-18.2	-18.2 0.25 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP	CH.	LL	=	23.3	PSF
		DL	=	3.0	PSF
BOT	CH.	LL	=	0.0	PSF
		DL	=	7.3	PSF
TOTAL LOAD		=	33.6	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.40")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.40")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.11")

CSI: TC=0.22/1.00 (C-D:1), BC=0.27/1.00 (G-H:4), WB=0.30/1.00 (B-H:1), SSI=0.15/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION	(PSI)	(PLI)
				MAX	MIN
MT20	618	354	1667	822	2284

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.76 (G) (INPUT = 0.90)
JSI METAL= 0.19 (D) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.





BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B37579H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-09, section 10.9.4.1.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to **wind** the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-09, section 10.9.4
10. This design is not valid after April 30, 2019.

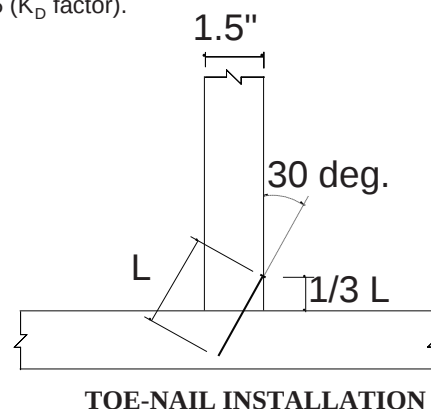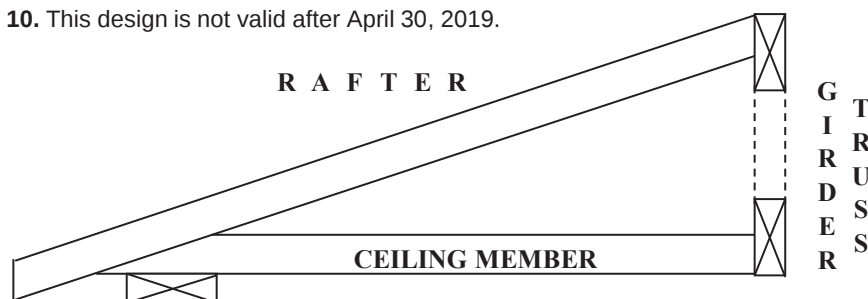

Nail type	Common wire	Common spiral	Common wire
Nail dia. (in)	0.160	0.152	0.144
	(3.5" nail)		(3" and 3.25" nail)
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS		
2X4 SPF	2	2	3
2X4 D. Fir	2	2	2
2X6 SPF	4	4	4
2X6 D. Fir	3	3	3



MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

PEO
Certificate No. 10889485



April 26, 2017



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B37579H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind or earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-09, section 10.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-09, section 10.9.5
9. This design is not valid after April 30, 2019

Toe-nailing on 2x6 Bearing Plate

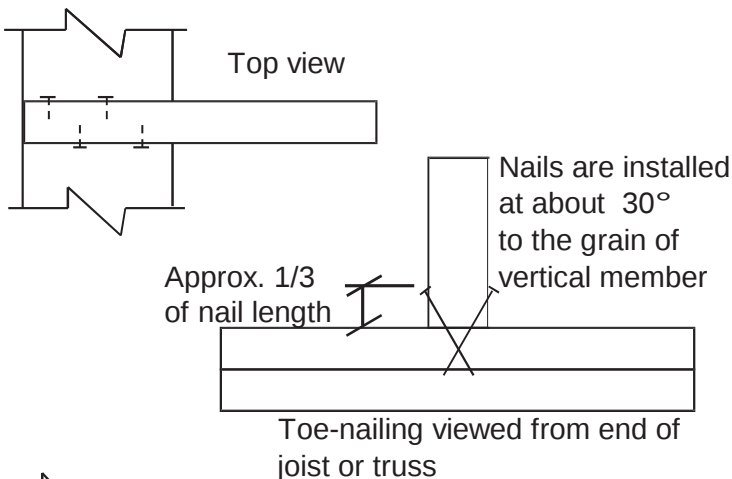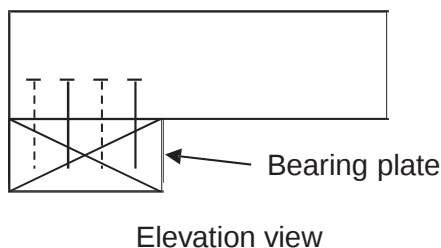

Toe-nailing on 2x4 Bearing Plate

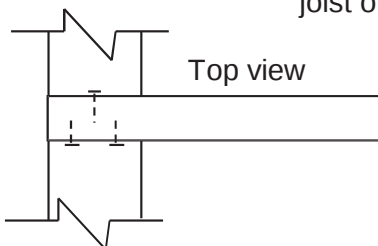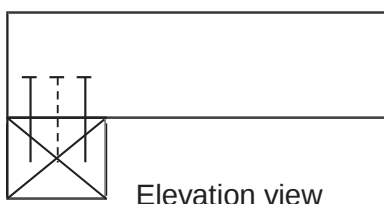

MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

PEO
Certificate No. 10889485



April 26, 2017