

ENGINEERING NOTE PAGE (ENP-1)
PLEASE READ PRIOR TO INSTALLATION

NE0518-226
GREEN YORK HOMES-
AMELIA 3 EL 2

RESPONSIBILITIES

THIS DESIGN IS FOR AN INDIVIDUAL BUILDING COMPONENT AND HAS BEEN BASED ON INFORMATION PROVIDED BY THE DESIGN OFFICE OF KOTT LUMBER. THE UNDERSIGNED ENGINEER DISCLAIMS ANY RESPONSIBILITY FOR DAMAGES AS A RESULT OF FAULTY OR INCORRECT INFORMATION, SPECIFICATION AND/OR DESIGNS FURNISHED TO THE ENGINEER. THE UNDERSIGNED ENGINEER IS ONLY RESPONSIBLE FOR THE STRUCTURAL INTEGRITY OF THIS BUILDING COMPONENT FOR THE CONDITIONS AND LOADS SHOWN ON THIS DRAWING. THE STRUCTURAL INTEGRITY OF THE BUILDING AND THE VERIFICATION OF THE DIMENSIONS AND THE DESIGN LOADS USED ARE THE RESPONSIBILITY OF THE BUILDING DESIGNER.

TRUSSES ARE DESIGNED IN CONFORMANCE WITH THE RELEVANT SECTIONS OF THE NATIONAL BUILDING CODE OF CANADA OR THE CANADIAN CODE FOR FARM BUILDINGS, WHICHEVER APPLIES TO THE BUILDING TYPE INDICATED ON THE DRAWING

IT IS THE RESPONSIBILITY OF KOTT LUMBER TO ENSURE THAT TRUSSES ARE MANUFACTURED IN CONFORMANCE WITH THESE DESIGNS AND WITH THE SPECIFICATIONS OUTLINED BELOW. THE UNDERSIGNED ENGINEER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

USE AND OCCUPANCY

- The building is of the type indicated on the drawing

LOADING

- The truss loading intensity and distribution as well as load transfer mechanism is that indicated on the drawing
- No buildings, trees, parapets or other projections higher than the roof for which the trusses are used are located within a distance less than ten (10) times the difference in height, or five metres (16 ft) whichever is greater, unless the drawing indicates that the snow drifting has been taken into account

HANDLING, INSTALLATION AND BRACING


- The trusses must be handled and installed by a qualified professional as per the supplied document titled *Information for Truss Installers* and the BCSI-B1 and BCSI-B3 Summary Sheets
- The compression chords are laterally braced by continuous rigid diaphragm sheathing or as specified on the drawing
- Temporary and permanent bracing must be installed as indicated on the truss drawing and according to the BCSI-B1 and BCSI-B3 Summary Sheets. Bracing for the lateral stability of the truss is to be provided by the building designer
- **It is recommended that a Professional Engineer's advice be obtained for the bracing of trusses spanning more than 12.37m (40'-7")**

SUPPORTS

- The trusses are to be supported at the bearing points indicated and anchored to the supports where considered necessary by the designer of the overall structure
- Bearing sizes shown are the minimum required to prevent crushing of the truss members and do not necessarily take into account stability of the overall building structure
- Elevation of bearings must be carefully checked and shimmed to alignment for solid bearings
- Adequate wood truss bearing is the responsibility of the building designer.

DIMENSIONS

- Geometry of the truss and dimensions indicated on the drawing are identical to those of the installed truss.

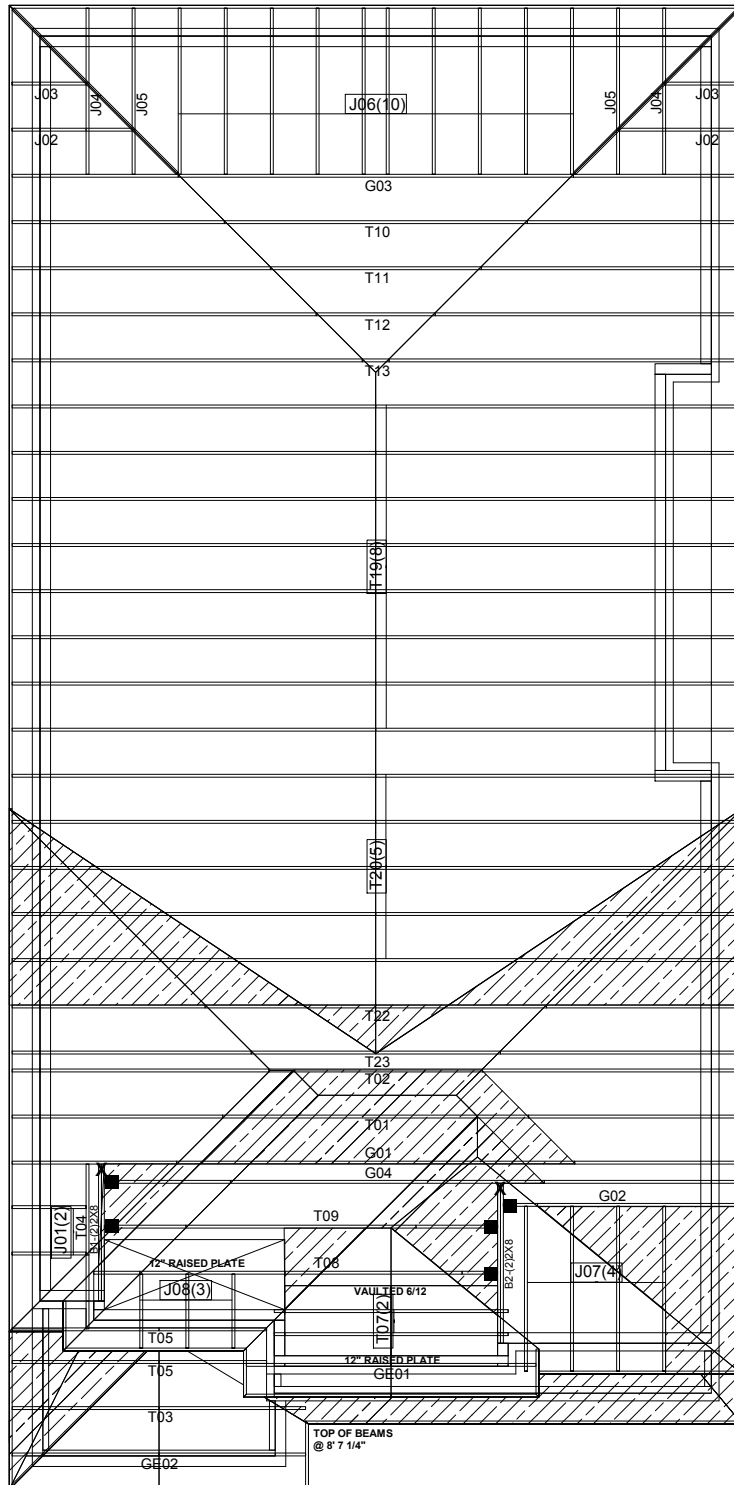

THIS CERTIFICATION IS FOR THE ENGINEERING REVIEW OF STRUCTURAL COMPONENTS SHOWN ON THIS DRAWING AND IS LIMITED TO THE COMPONENTS SUPPLIED BY KOTT LUMBER FOR THE LOADS AND CONDITIONS SHOWN ON THE CALCULATION PAGE OF EACH COMPONENT. THE PLACEMENT OF THESE COMPONENTS ON THIS LAYOUT IS SHOWN FOR REFERENCE ONLY. ROOF TRUSSES MUST BE INSTALLED ACCORDING TO MANUFACTURER'S GUIDELINES AT 24" C/C UNLESS NOTED OTHERWISE. CONVENTIONAL FRAMING SHOWN ON THE LAYOUT MUST BE DESIGNED AND APPROVED BY THE PROJECT ENGINEER. TEMPORARY AND PERMANENT BRACINGS OF THE ROOF AND BUILDING ARE THE RESPONSIBILITY OF THE PROJECT ENGINEER AND TO CONFORM TO BCSI GUIDELINES.



The components shown on this layout conform to our recommendations and are adequate to support the design loads required by the Ontario Building Code O.Reg 332/12 as amended and as shown on the engineering calculation page of each component.

The framing direction and girder locations shown on this layout conform to that shown on the architectural drawing.

Deflection: $LL = L/360$
 $1.33LL + DL = L/360$

Architectural Drawing Info:
 Date: MAY 22, 2018
 Project number: 17-55
 Model: AMELIA 3



CONVENTIONAL FRAMING BY OTHERS

ALL CONVENTIONAL FRAMING TO CONFORM WITH PART 9 OF THE O.B.C.
 ROOF RAFTERS THAT CROSS MEET OVER TRUSSES TO BE 2x4 S.P.F. @ 24" O/C WITH A 2x4 VERTICAL POST TO THE TRUSS UNDERNEATH EACH CROSS POINT. VERTICAL POST LONGER THAN 6' TO HAVE LATERAL BRACING SO THAT THE DISTANCE BETWEEN END POINT AND BETWEEN ROWS OF BRACING DOES NOT EXCEED 6'.

HANGER LEGEND:

▼ LUS24 ■ LJS26DS
 ● HGUS26 ✕ HGUS26-2

SIZE AND LOCATION OF CONVENTIONAL FRAMING IS APPROXIMATE. ALL AREAS MAY NOT BE SHOWN. REFER TO ARCHITECTURAL PLANS FOR DETAILS.

DESIGN CRITERIA
 SPECIFIED LOADS:
 TOP CH. LL = 23.3 PSF
 DL = 3 PSF
 BOT CH. LL = 0 PSF
 DL = 7 PSF
 TOTAL LOAD = 33.3 PSF
 SPACING = 24" O/C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
 - PART 9 OF OBC 2012, BCBC 2012, ABC 2014
 - CSA 086-09
 - TPC 2011


Model: **AMELIA 3 EL 2 4 & 5 BED**

Customer: GREEN YORK HOMES

Project: GRENALLI HOMES

Location: BRAMPTON

Date: 5/30/2018 Drawn by: BB

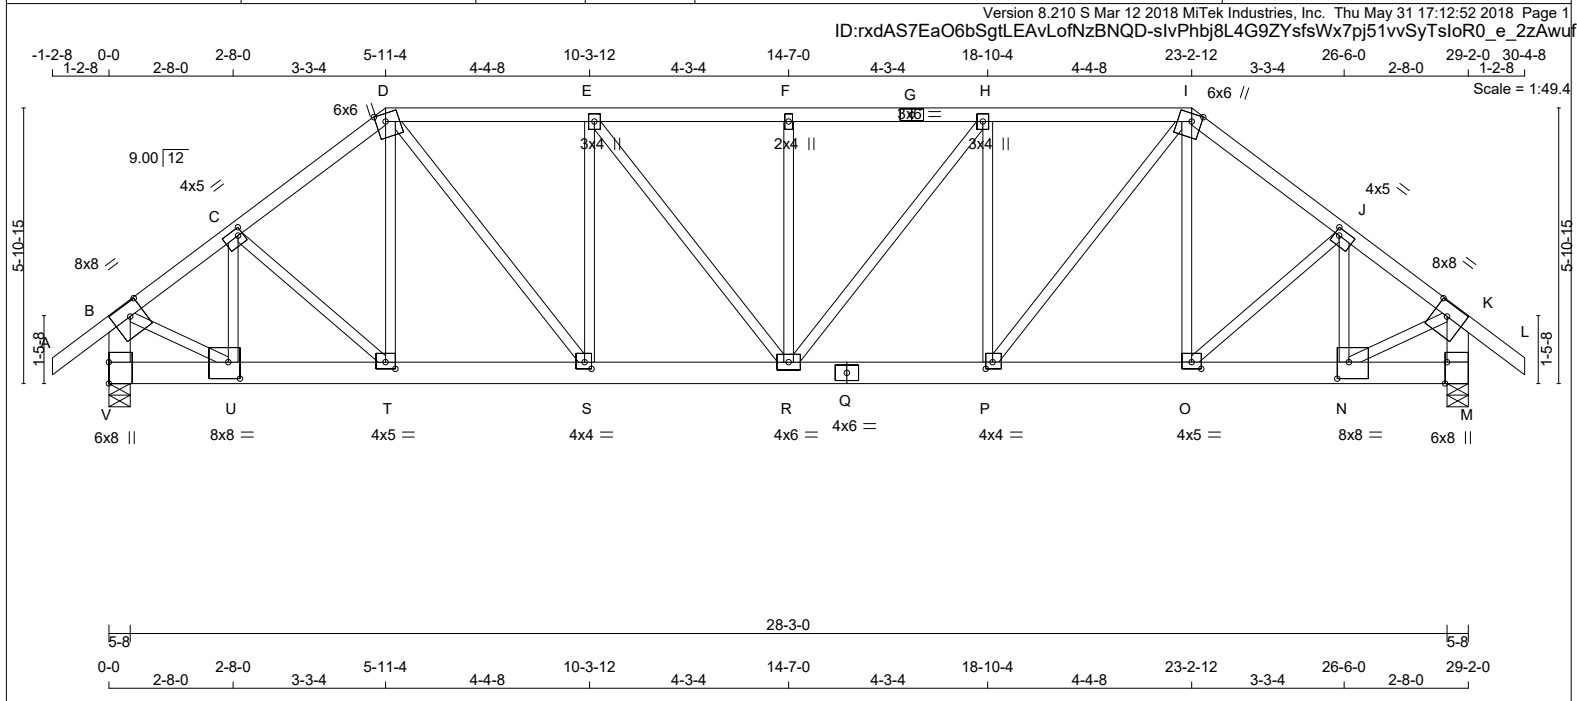

HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S)
REQUIRED TO SUPPORT CONCENTRATED
LOAD(S) 2797.1 lbs FACTORED DOWN AT 2-8-0
ON BOTTOM CHORD. DESIGN FOR
UNSPECIFIED CONNECTION(S) IS DELEGATED
TO THE BUILDING DESIGNER.



READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.

TRUSS PLATE MANUFACTURER IS NOT
RESPONSIBLE FOR QUALITY CONTROL IN
THE TRUSS MANUFACTURING PLANT .

NAIL VALUES


PLATE	GRIP(DRY) (PS)	SHEAR (PL)	SECTION (PL)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (D) (INPUT = 0.90)
JSI METAL= 0.80 (K) (INPUT = 1.00)



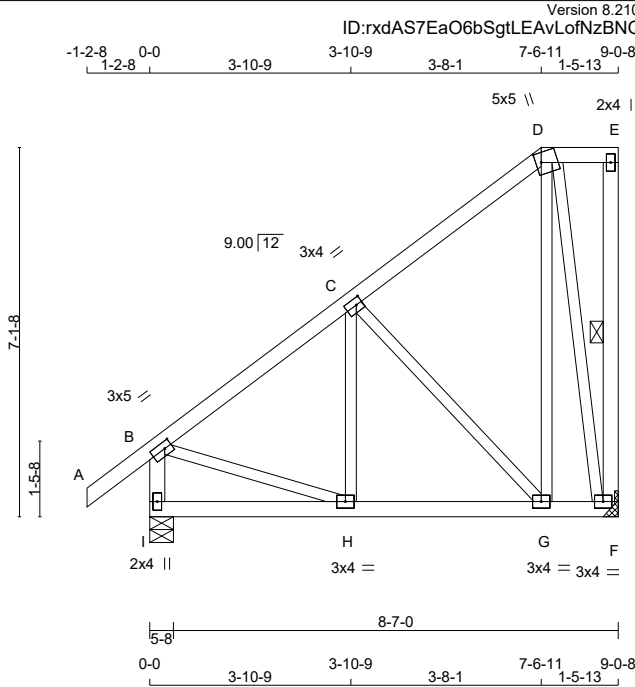

TOTAL WEIGHT = 54 lb [M]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
F - E	2x4	DRY	No.2	SPF
I - B	2x4	DRY	No.2	SPF
I - F	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	3.0	5.0	1.50	1.75
C	TMWW-t	MT20	3.0	4.0	1.50	1.50
D	TTWW+m	MT20	5.0	5.0	2.25	1.25
E	TMV+p	MT20	2.0	4.0		
F	BMVW1-t	MT20	3.0	4.0		
G	BMWW-t	MT20	3.0	4.0		
H	BMWW-t	MT20	3.0	4.0		
I	BMV1+p	MT20	2.0	4.0		

HANGERS NOTES

- SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 432.4 lbs FACTORED DOWN AT 7-6-11 ON TOP CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	UPLIFT
F	951	0	951	0
I	677	0	677	0

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT F TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	664	483/0	0/0	0/0	0/0	181/0	0/0
I	478	319/0	0/0	0/0	0/0	159/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 - 1x4 LATERAL BRACE(S) AT 1/2 LENGTH OF E-F. DBS = 20-0-0 . CBF = 13 LBS.

DBS = DIAGONAL BRACE SPACING (MAX). CBF = CUMULATIVE BRACING FORCE (PER BRACE). FASTEN LATERAL BRACE(S) USING (0.122"x3") SPIRAL NAILS : 1 NAIL FOR 2x3 BRACE(S), 2 FOR 1x4, 2x4, 2x5, 3 FOR 2x6, 4 FOR 2x8, 5 FOR 2x10, AND 6 FOR 2x12.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0/30	-77.4 -77.4	0.10 (1)	10.00	H-C	0/127	0.05 (4)
B-C	-473/0	-77.4 -77.4	0.20 (1)	6.25	C-G	-325/0	0.17 (1)
C-D	-238/0	-77.4 -77.4	0.20 (1)	6.25	G-D	0/299	0.07 (1)
D-E	0/0	-144.6 -144.6	0.06 (1)	10.00	D-F	-834/0	0.77 (1)
F-E	-107/0	0.0 0.0	0.03 (1)	6.25	B-H	0/411	0.10 (1)
I-B	-628/0	0.0 0.0	0.07 (1)	7.81			
I-H	0/0	-32.7 -32.7	0.14 (4)	10.00			
H-G	0/395	-32.7 -32.7	0.17 (4)	10.00			
G-F	0/178	-32.7 -32.7	0.05 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
D	7-6-11	-432	-432	---	FRONT	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.0	PSF
TOTAL LOAD	=	33.3	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

GIRDER TYPE: CPrimeHip

LEFT SETBACK = 7-6-11
RIGHT SETBACK = 0-0
END WALL WIDTH = 5-8
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO FRONT SIDE
- ADDTL LOADS BASED ON 55 % OF GSL.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.30")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.30")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.20/1.00 (B-C:1) , BC=0.17/1.00 (G-H:4) , WB=0.77/1.00 (D-F:1) , SSI=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	822	2284	1656

CONTINUED ON PAGE 2

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
NE0518-226	G02	1	1	GREEN YORK HOMES-AMELIA 3 EL 2	
				TRUSS DESC.	PAGE 6 OF 40


Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu May 31 17:12:53 2018 Page 2
ID:rdAS7EaO6bSgtLEAvLoFnzBNQD-KUTnuxjn6OO0AiRrQESMMxdEwJuDCLRyggkBXUzAwue

PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.88 (F) (INPUT = 0.90)
JSI METAL= 0.19 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



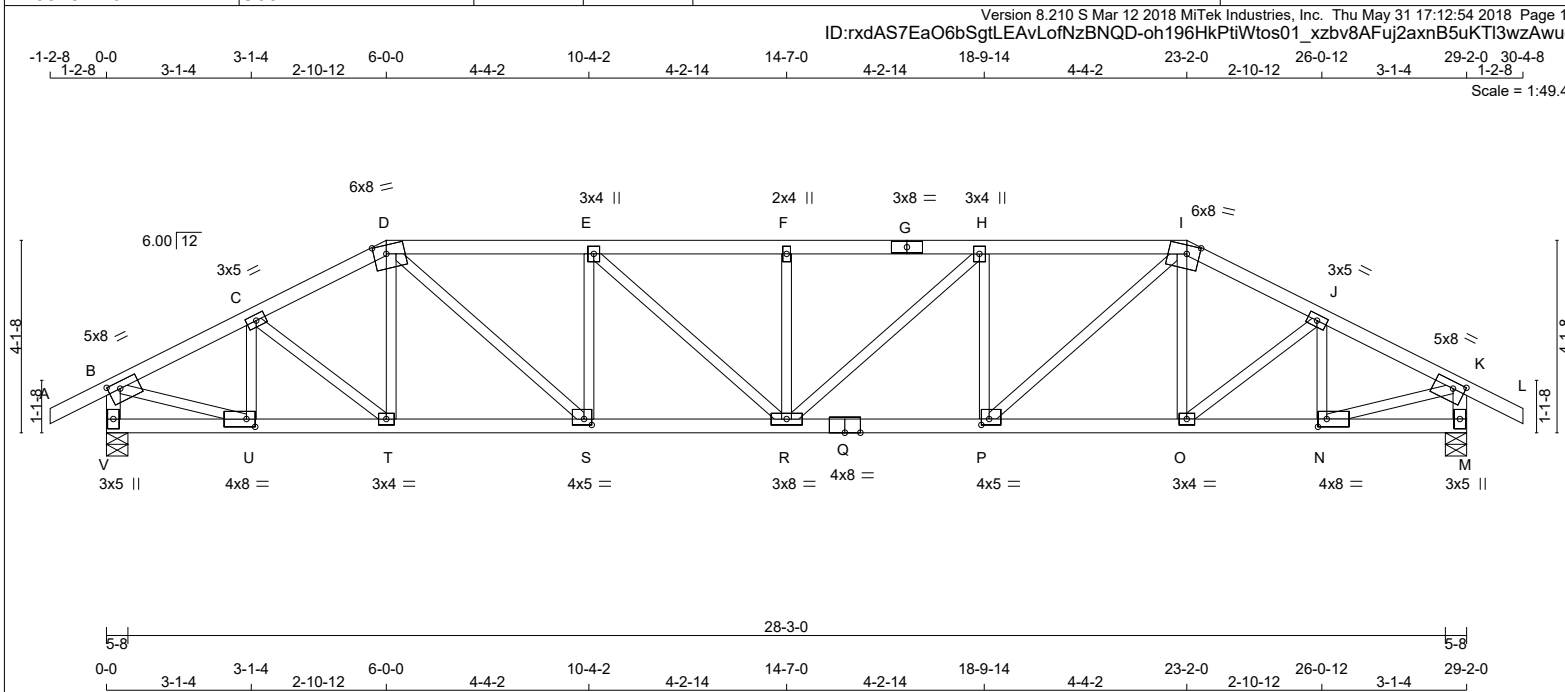

TOTAL WEIGHT = 119 lb

LUMBER				
N. L. G. A. RULES				
CHORDS		SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
I - L	2x4	DRY	No.2	SPF
V - B	2x4	DRY	No.2	SPF
M - K	2x4	DRY	No.2	SPF
V - Q	2x4	DRY	No.2	SPF
Q - M	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)		PLATES				
JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	8.0	1.75	3.00
C	CTMWW-t	MT20	3.0	5.0		
D	TTWW-m	MT20	6.0	8.0	2.25	3.25
E	TMWW-t	MT20	3.0	4.0		
F	TMW+w	MT20	2.0	4.0		
G	TS-t	MT20	3.0	8.0		
H	MTWW+t	MT20	3.0	4.0		
I	TTWW-m	MT20	6.0	8.0	2.25	3.25
J	TMWW-t	MT20	3.0	5.0		
K	TMVW-t	MT20	5.0	8.0	1.75	3.00
M	BMV1+p	MT20	3.0	5.0		
N	BMWW-t	MT20	4.0	8.0	2.00	2.25
O	BMWW-t	MT20	3.0	4.0		
P	BMWW-t	MT20	4.0	5.0	1.50	2.00
Q	BS-t	MT20	4.0	8.0		
R	BMWWW-t	MT20	3.0	8.0		
S	BMWW-t	MT20	4.0	5.0	1.50	2.00
T	BMWW-t	MT20	3.0	4.0		
U	BMWW-t	MT20	4.0	8.0	2.00	2.25
V	BMV1+p	MT20	3.0	5.0		

HANGERS NOTES

1)



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
V	2644	0	2644	0	0	5-8
M	2644	0	2644	0	0	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
V	1855	1302 / 0	0 / 0	0 / 0	0 / 0	553 / 0	0 / 0
M	1855	1302 / 0	0 / 0	0 / 0	0 / 0	553 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.15 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX FACTORED CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 22	-77.4	-77.4	0.10 (1)	10.00	U-C	-748 / 0 0.13 (1)
B-C	-3483 / 0	-77.4	-77.4	0.12 (1)	3.51	C-T	0 / 473 0.12 (1)
C-D	-3915 / 0	-77.4	-77.4	0.30 (1)	3.30	T-D	-147 / 76 0.04 (1)
D-E	-4840 / 0	-145.9	-145.9	0.83 (1)	2.36	D-S	0 / 1802 0.45 (1)
E-F	-5231 / 0	-145.9	-145.9	0.89 (1)	2.15	S-E	-1054 / 0 0.29 (1)
F-G	-5231 / 0	-145.9	-145.9	0.89 (1)	2.15	E-R	0 / 527 0.13 (1)
G-H	-5231 / 0	-145.9	-145.9	0.89 (1)	2.15	R-F	-570 / 0 0.15 (1)
H-I	-4840 / 0	-145.9	-145.9	0.83 (1)	2.36	R-H	0 / 527 0.13 (1)
I-J	-3915 / 0	-77.4	-77.4	0.30 (1)	3.30	P-H	-1054 / 0 0.29 (1)
J-K	-3483 / 0	-77.4	-77.4	0.28 (1)	3.51	P-I	0 / 1802 0.45 (1)
K-L	0 / 22	-77.4	-77.4	0.10 (1)	10.00	O-I	-147 / 76 0.04 (1)
V-B	-2586 / 0	0.0	0.0	0.29 (1)	5.28	O-J	0 / 473 0.12 (1)
M-K	-2586 / 0	0.0	0.0	0.29 (1)	5.28	N-J	-748 / 0 0.13 (1)
						B-U	0 / 3226 0.80 (1)
V-U	0 / 0	-33.0	-33.0	0.08 (4)	10.00	N-K	0 / 3226 0.80 (1)
U-T	0 / 3120	-33.0	-33.0	0.62 (1)	10.00		
T-S	0 / 3488	-33.0	-33.0	0.68 (1)	10.00		
S-R	0 / 4840	-33.0	-33.0	0.93 (1)	10.00		
R-Q	0 / 4840	-33.0	-33.0	0.93 (1)	10.00		
Q-P	0 / 4840	-33.0	-33.0	0.93 (1)	10.00		
P-O	0 / 3488	-33.0	-33.0	0.68 (1)	10.00		
O-N	0 / 3120	-33.0	-33.0	0.62 (1)	10.00		
N-M	0 / 0	-33.0	-33.0	0.08 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
D	6-0-0	-348	-348	---	FRONT	VERT	TOTAL
I	23-2-0	-348	-348	---	FRONT	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:

TOP	CH.	LL	=	23.3	PSF
		DL	=	3.0	PSF
BOT	CH.	LL	=	0.0	PSF
		DL	=	7.0	PSF
TOTAL LOAD				=	33.3 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A
SLOPE OF 2.00/12 MINIMUM

GIRDER TYPE: CPrimeHip
SIDE SETBACK = 6-0-0
END SETBACK = 6-0-0
END WALL WIDTH = 5-8
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO FRONT SIDE
- ADD'T'L LOADS BASED ON 55 % OF GSL.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.27")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/ 739 (0.47")

CSI: TC=0.89/1.00 (F-H:1) , BC=0.93/1.00 (P-R:1) ,
WB=0.80/1.00 (K-N:1) , SSI=0.32/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES						
PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

CONTINUED ON PAGE 2



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
NE0518-226	G03	1	1	GREEN YORK HOMES-AMELIA 3 EL 2	
				TRUSS DESC.	PAGE 8 OF 40

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu May 31 17:12:54 2018 Page 2
ID: rxdAS7EaO6bSgtLEAvLofNzBNQD-oh196HkPtIWtos01_xzbv8AFuj2axnB5uKTI3wzAwud


HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 348.1 lbs FACTORED DOWN AT 23-2-0, AND 348.1 lbs FACTORED DOWN AT 6-0-0 ON TOP CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.90 (I) (INPUT = 0.90)
JSI METAL= 0.94 (Q) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



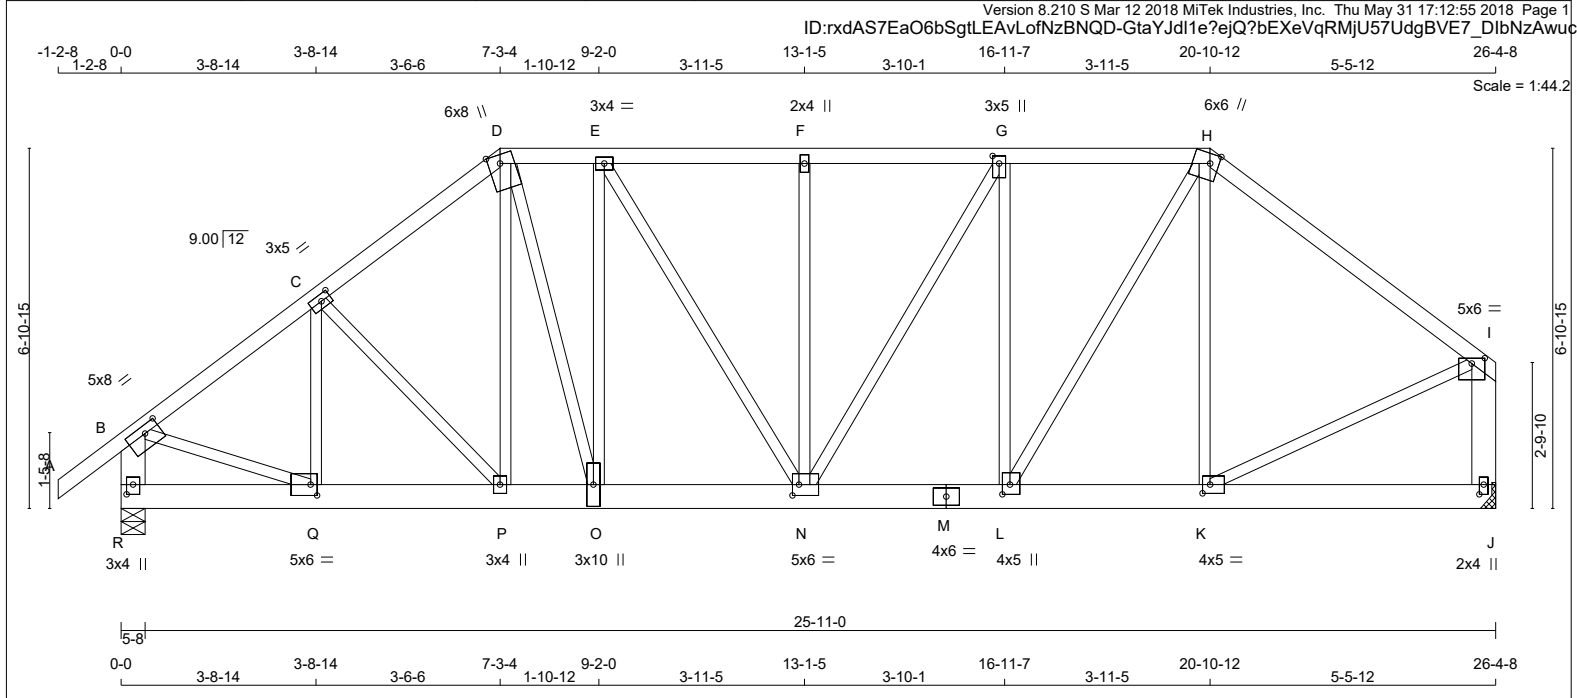

TOTAL WEIGHT = 151 lb [M]

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - H	2x4	DRY	No.2	SPF
H - I	2x4	DRY	No.2	SPF
R - B	2x6	DRY	No.2	SPF
J - I	2x6	DRY	No.2	SPF
R - M	2x6	DRY	No.2	SPF
M - J	2x6	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	8.0	1.75	3.50
C	TMVW-t	MT20	3.0	5.0	1.50	2.25
D	TTWW+m	MT20	6.0	8.0	Edge	2.75
E	TMVW-t	MT20	3.0	4.0		
F	TMVW-t	MT20	2.0	4.0		
G	TMVW-t	MT20	3.0	5.0	1.75	1.50
H	TTWW+m	MT20	6.0	6.0	Edge	2.00
I	TMVW-p	MT20	5.0	6.0	1.25	3.00
J	BMV1+p	MT20	2.0	4.0	2.25	1.00
K	BMVW-t	MT20	4.0	5.0	2.00	1.75
L	BMVW-t	MT20	4.0	5.0	2.25	1.75
M	BS-t	MT20	4.0	6.0		
N	BMVW-t	MT20	5.0	6.0	2.50	1.50
O	BMVW-t	MT20	3.0	10.0		
P	BMVW-t	MT20	3.0	4.0		
Q	BMVW-t	MT20	5.0	6.0	2.50	1.50
R	BMV1+p	MT20	3.0	4.0	2.25	1.50

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES
1)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
R	2815	0	2815	0	5-8	5-8
J	2030	0	2030	0	MECHANICAL	

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT J TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS							
	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	1973	1393 / 0	0 / 0	0 / 0	0 / 0	580 / 0	0 / 0
J	1425	997 / 0	0 / 0	0 / 0	0 / 0	428 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.52 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 30	-77.4	-77.4 0.10 (1)	10.00	Q-C	-720 / 0	0.19 (1)
B-C	-3065 / 0	-77.4	-77.4 0.33 (1)	3.70	C-P	0 / 295	0.07 (1)
C-D	-3362 / 0	-77.4	-77.4 0.35 (1)	3.52	P-D	0 / 102	0.03 (1)
D-E	-3172 / 0	-77.4	-77.4 0.19 (1)	3.75	D-O	0 / 1796	0.44 (1)
E-F	-2859 / 0	-77.4	-77.4 0.27 (1)	3.86	O-E	0 / 314	0.08 (1)
F-G	-2859 / 0	-77.4	-77.4 0.29 (1)	3.83	E-N	-605 / 0	0.69 (1)
G-H	-2298 / 0	-77.4	-77.4 0.25 (1)	4.25	N-F	-310 / 0	0.24 (1)
H-I	-1887 / 0	-77.4	-77.4 0.61 (1)	4.21	N-G	0 / 1106	0.27 (1)
R-B	-2756 / 0	0.0	0.0 0.20 (1)	6.25	L-G	-1276 / 0	0.99 (1)
J-I	-1993 / 0	0.0	0.0 0.20 (1)	7.11	L-H	0 / 1545	0.38 (1)
					K-H	-534 / 0	0.41 (1)
R-Q	0 / 0	-17.5	-17.5 0.07 (1)	10.00	B-Q	0 / 2561	0.63 (1)
Q-P	0 / 2466	-17.5	-17.5 0.43 (1)	10.00	K-I	0 / 1640	0.41 (1)
P-O	0 / 2670	-17.5	-17.5 0.50 (1)	10.00			
O-N	0 / 3172	-17.5	-17.5 0.56 (1)	10.00			
N-M	0 / 2299	-17.5	-17.5 0.32 (1)	10.00			
M-L	0 / 2299	-17.5	-17.5 0.32 (1)	10.00			
L-K	0 / 1499	-17.5	-17.5 0.24 (1)	10.00			
K-J	0 / 0	-17.5	-17.5 0.06 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
O	9-2-0	-2243	-2243	---	FRONT	VERT	TOTAL

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL	PSF
DL	23.3	PSF
BOT CH.	LL	PSF
DL	0.0	PSF
DL	7.0	PSF
TOTAL LOAD	33.3	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

*** NON STANDARD GIRDER ***
ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.88")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.10")
ALLOWABLE DEFL.(TL)= L/360 (0.88")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.18")

CSI: TC=0.61/1.00 (H-I:1), BC=0.56/1.00 (N-O:1), WB=0.99/1.00 (G-L:1), SSI=0.15/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667 822 2284 1656

CONTINUED ON PAGE 2




HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S)
REQUIRED TO SUPPORT CONCENTRATED
LOAD(S) 2242.8 lbs FACTORED DOWN AT 9-2-0
ON BOTTOM CHORD. DESIGN FOR
UNSPECIFIED CONNECTION(S) IS DELEGATED
TO THE BUILDING DESIGNER.

PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.90 (C) (INPUT = 0.90)
JSI METAL= 0.62 (Q) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



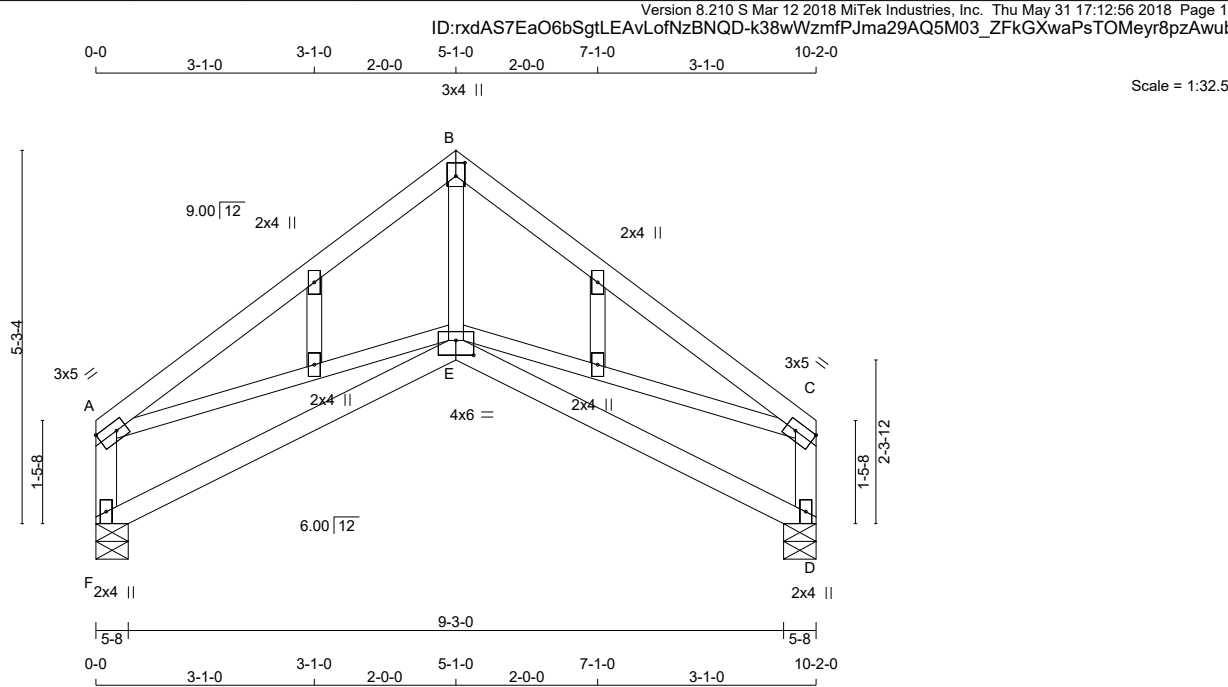

TOTAL WEIGHT = 43 lb

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
F - A	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - E	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DESCR.
SPF
SPF
SPF
SPF
SPF
SPF

ALL WEBS EXCEPT	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2

DRY: SEASONED LUMBER.

SPF
SPF

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	3.0	5.0	1.50	Edge
B	TTW+p	MT20	3.0	4.0	2.25	1.50
C	TMVW-t	MT20	3.0	5.0	1.50	Edge
D	BMV1+p	MT20	2.0	4.0		
E	BBWW-p	MT20	4.0	6.0	2.50	3.00
F	BMV1+p	MT20	2.0	4.0		
G, H, I, J						
G	NP+w	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
F	482	0	482	0	5-8	5-8
D	482	0	482	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	338	237 / 0	0 / 0	0 / 0	0 / 0	102 / 0	0 / 0
D	338	237 / 0	0 / 0	0 / 0	0 / 0	102 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)
FR-TO		FROM TO	FR-TO	FROM TO
A-B	-586 / 0	-77.4 -77.4 0.26 (1)	6.25	E-B 0 / 310 0.07 (1)
B-C	-586 / 0	-77.4 -77.4 0.26 (1)	6.25	A-E 0 / 482 0.11 (1)
F-A	-438 / 0	0.0 0.0 0.05 (1)	7.81	E-C 0 / 482 0.11 (1)
D-C	-438 / 0	0.0 0.0 0.05 (1)	7.81	
F-E	0 / 0	-17.5 -17.5 0.13 (4)	10.00	
E-D	0 / 0	-17.5 -17.5 0.13 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3 PSF
	DL = 3.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.0 PSF
TOTAL LOAD	= 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.34")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.34")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.26/1.00 (A-B:1), BC=0.13/1.00 (D-E:4), WB=0.11/1.00 (A-E:1), SSI=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.69 (E) (INPUT = 0.90)
JSI METAL= 0.21 (A) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



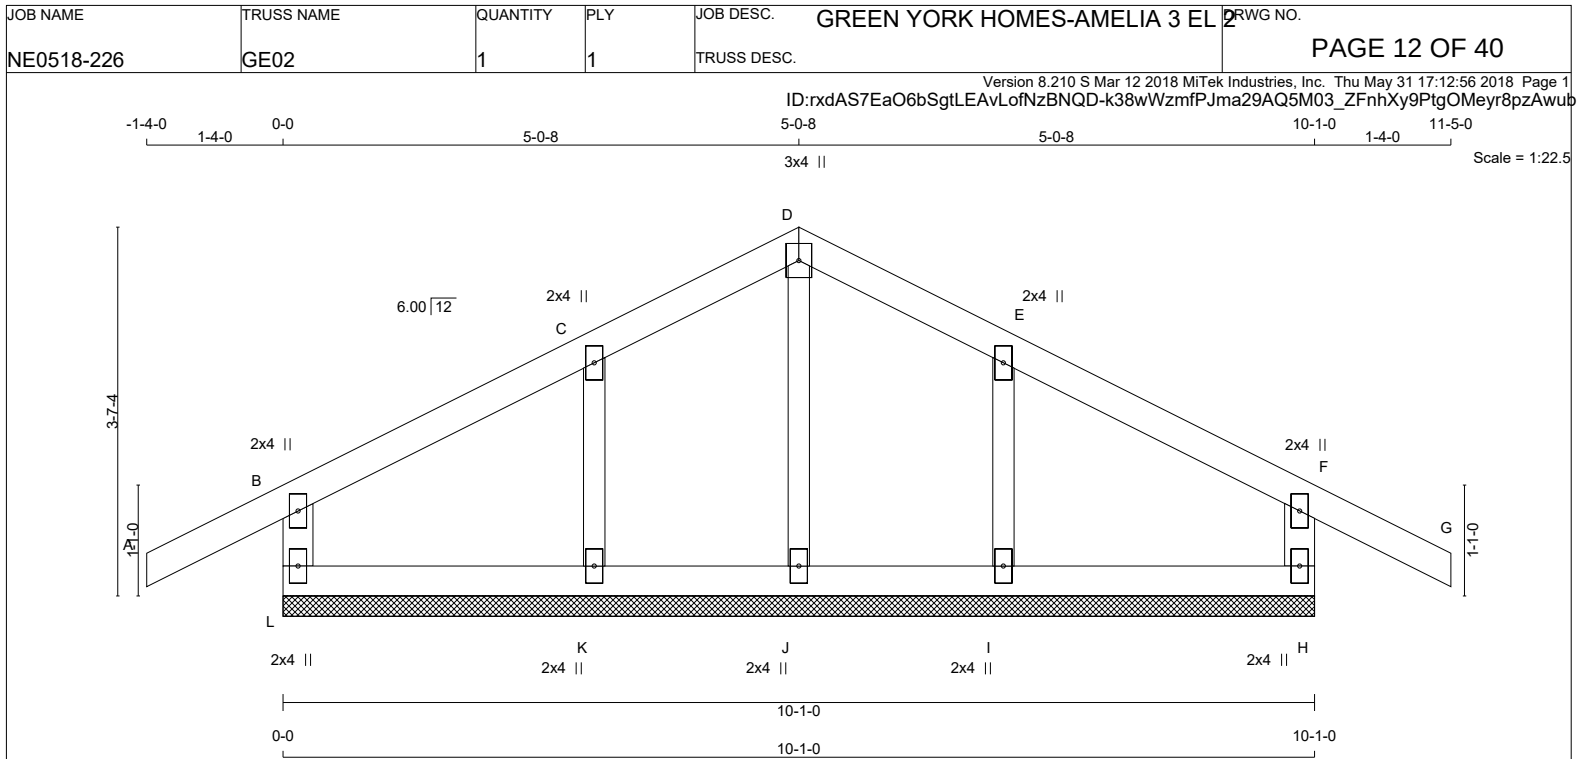

TOTAL WEIGHT = 35 lb [M]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	DRY	LUMBER	DESCR.
L - B	2x4	DRY	No.2	SPF
A - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF
L - H	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
ALL GABLE WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				
GABLE STUDS SPACED AT 2'-0" OC.				

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	2.0	4.0
C	TMW+w	MT20	2.0	4.0
D	TTW+p	MT20	3.0	4.0
E	TMW+w	MT20	2.0	4.0
F	TMV+p	MT20	2.0	4.0
H	BMV1+p	MT20	2.0	4.0
I, J, K				
I	BMW1+w	MT20	2.0	4.0
L	BMV1+p	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LC1 (LC)	UNBRACED LENGTH
FR-TO		FROM TO		FR-TO			
L-B	-240 / 0	0.0	0.0 0.02 (4)	J-D	-122 / 0	0.03 (1)	
A-B	0 / 24	-77.4	-77.4 0.11 (1)	K-C	-197 / 0	0.03 (1)	
B-C	-26 / 0	-77.4	-77.4 0.09 (1)	I-E	-197 / 0	0.03 (1)	
C-D	-21 / 0	-77.4	-77.4 0.06 (1)				
D-E	-21 / 0	-77.4	-77.4 0.06 (1)				
E-F	-26 / 0	-77.4	-77.4 0.09 (1)				
F-G	0 / 24	-77.4	-77.4 0.11 (1)				
H-F	-240 / 0	0.0	0.0 0.02 (4)				
L-K	0 / 20	-17.5	-17.5 0.03 (4)				
K-J	0 / 14	-17.5	-17.5 0.03 (4)				
J-I	0 / 14	-17.5	-17.5 0.03 (4)				
I-H	0 / 20	-17.5	-17.5 0.03 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 23.3 PSF

DL = 3.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.0 PSF

TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.11/1.00 (F-G:1), BC=0.03/1.00 (H-I:4), WB=0.03/1.00 (E-I:1), SSI=0.09/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.15 (B) (INPUT = 0.90)

JSI METAL= 0.06 (F) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



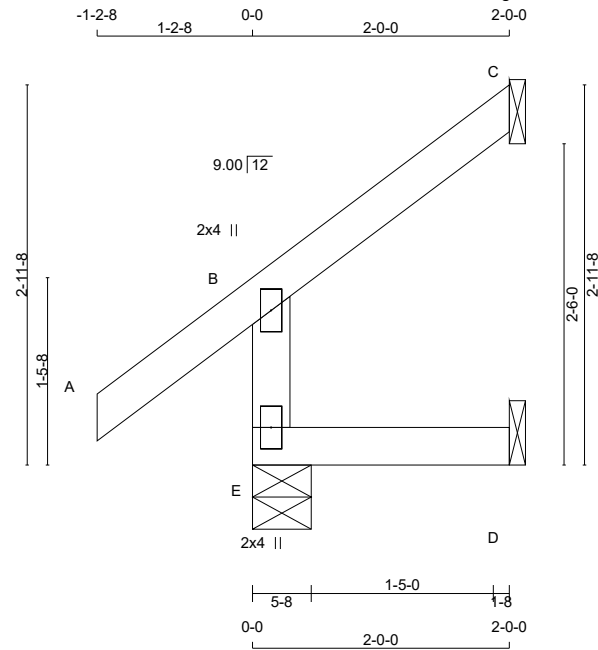

Scale = 1:17.9

TOTAL WEIGHT = 2 X 8 = 17 lb [M]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	SPF
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	2.0	4.0
E	BMV1+p	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
E	216	0	216	0	5-8	5-8		
C	59	0	59	0	1-8	1-8		
D	16	0	18	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
E	149	118 / 0	0 / 0	0 / 0	0 / 0	31 / 0	0 / 0
C	40	35 / 0	0 / 0	0 / 0	0 / 0	5 / 0	0 / 0
D	13	0 / 0	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)
FR-TO		FROM TO		FR-TO
E-B	-196 / 0	0.0 0.0 0.01 (4)	7.81	
A-B	0 / 30	-77.4 -77.4 0.09 (1)	10.00	
B-C	-11 / 0	-77.4 -77.4 0.05 (1)	6.25	
E-D	0 / 0	-17.5 -17.5 0.02 (4)	10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.0	PSF
TOTAL LOAD	=	33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.00")

CSI: TC=0.09/1.00 (A-B:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.06/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
	(PSI)	(PLI)	(PLI)		
	MAX	MIN	MAX	MIN	MAX
MT20	618	354	1667	822	2284

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.13 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



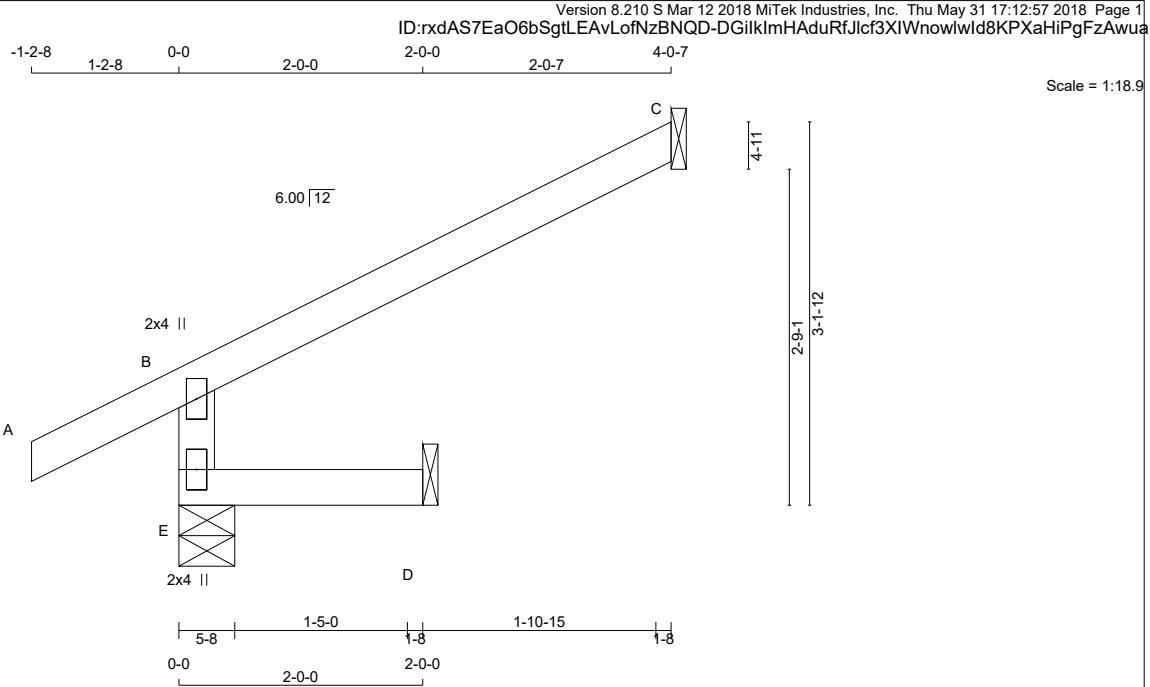

TOTAL WEIGHT = 2 X 10 = 20 lb [M]

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
E	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
E	313	0	313	0	5-8	5-8
C	117	0	117	0	1-8	1-8
D	16	0	17	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS				
		COMBINED	SNOW	LIVE	PERM. LIVE	WIND
E	215	177 / 0	0 / 0	0 / 0	0 / 0	38 / 0
C	80	71 / 0	0 / 0	0 / 0	0 / 0	9 / 0
D	12	0 / 0	0 / 0	0 / 0	0 / 0	12 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING							
TOTAL LOAD CASES: (4)							
CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH
FR-TO		FROM	TO		FR-TO		
E-B	-294 / 0	0.0	0.0	0.01 (4)	7.81		
A-B	0 / 22	-77.4	-77.4	0.09 (1)	10.00		
B-C	-17 / 0	-77.4	-77.4	0.21 (1)	6.25		
E-D	0 / 0	-17.5	-17.5	0.02 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.00")

CSI: TC=0.21/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.14/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



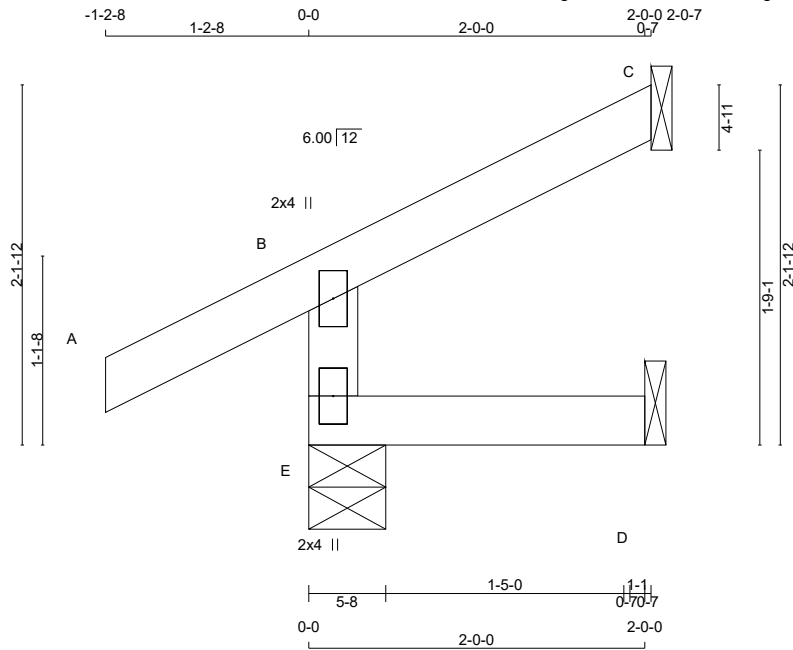

Scale = 1:13.7

TOTAL WEIGHT = 2 X 7 = 15 lb [M]

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
E	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
E	216	0	216	0	5-8	5-8
C	59	0	59	0	1-8	1-8
D	16	0	17	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS				
		COMBINED	SNOW	LIVE	PERM. LIVE	WIND
E	149	118 / 0	0 / 0	0 / 0	0 / 0	31 / 0
C	40	36 / 0	0 / 0	0 / 0	0 / 0	5 / 0
D	12	0 / 0	0 / 0	0 / 0	0 / 0	12 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (FT)	MAX. FACTORED FORCE (LBS)
FR-TO				
E-B	-197 / 0	0.0	0.01 (4)	7.81
A-B	0 / 22	-77.4	0.09 (1)	10.00
B-C	-9 / 0	-77.4	0.05 (1)	10.00
E-D	0 / 0	-17.5	0.02 (4)	10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.00")

CSI: TC=0.09/1.00 (A-B:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.07/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.11 (B) (INPUT = 0.90)
JSI METAL= 0.04 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



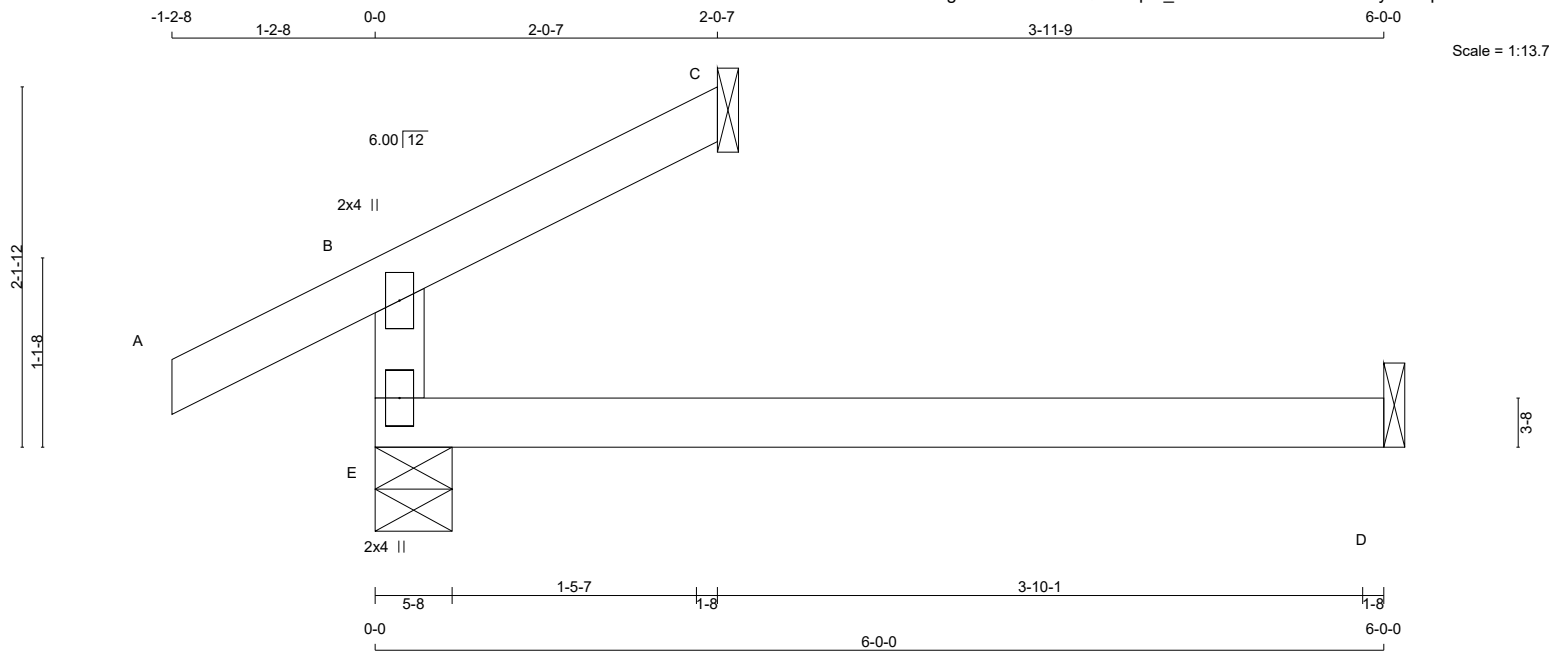

TOTAL WEIGHT = 2 X 12 = 24 lb [M][F]

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
E	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
E	258	0	258	0	5-8	5-8
C	59	0	59	0	1-8	1-8
D	43	0	48	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS				
		SNOW	LIVE	PERM. LIVE	WIND	DEAD
E	183	118 / 0	0 / 0	0 / 0	0 / 0	65 / 0
C	40	36 / 0	0 / 0	0 / 0	0 / 0	5 / 0
D	35	0 / 0	0 / 0	0 / 0	0 / 0	35 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)
FR-TO		FROM TO		FR-TO
E-B	-197 / 0	0.0 0.0 0.11 (4)	7.81	
A-B	0 / 22	-77.4 -77.4 0.09 (1)	10.00	
B-C	-9 / 0	-77.4 -77.4 0.04 (1)	10.00	
E-D	0 / 0	-17.5 -17.5 0.13 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.03")

CSI: TC=0.11/1.00 (B-E:4), BC=0.13/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SSI=0.08/1.00 (D-E:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.11 (B) (INPUT = 0.90)
JSI METAL= 0.04 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



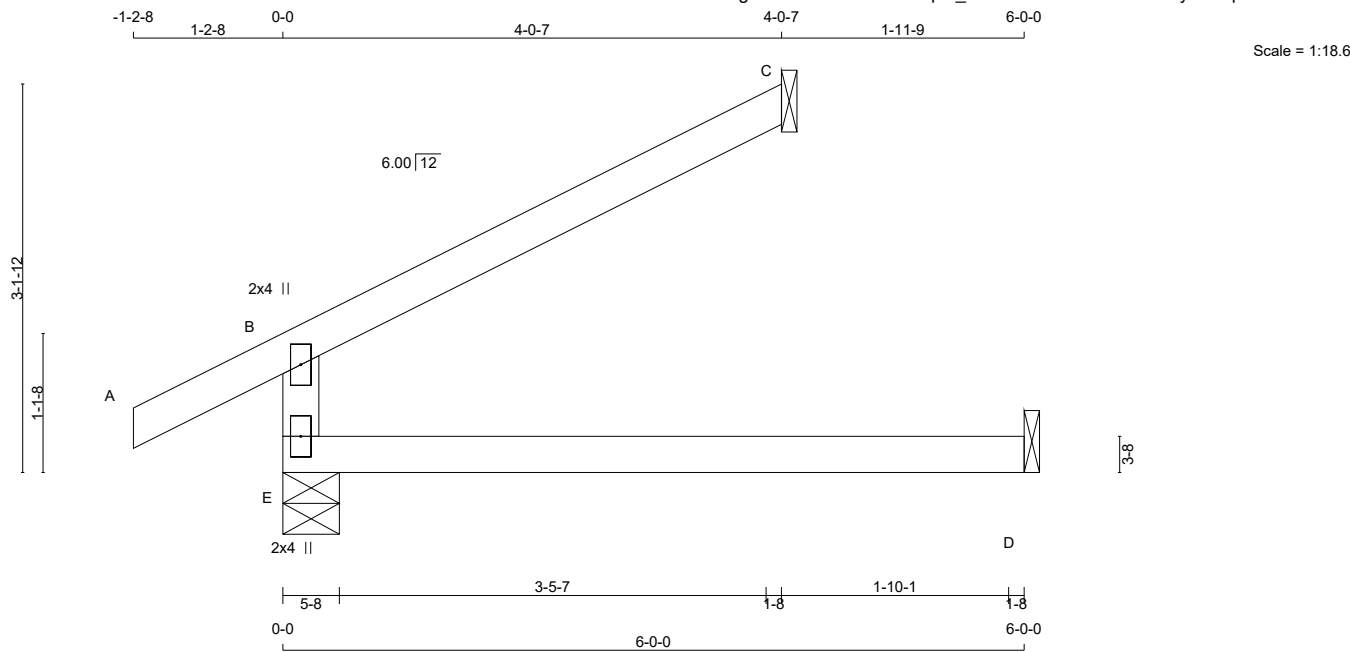

TOTAL WEIGHT = 2 X 14 = 29 lb
[M][F]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	2.0	4.0
E	BMV1+p	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
E	355	0	355	0	5-8	5-8
C	117	0	117	0	1-8	1-8
D	43	0	48	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
E	249	177 / 0	0 / 0	0 / 0	0 / 0	72 / 0	0 / 0
C	80	71 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0
D	35	0 / 0	0 / 0	0 / 0	0 / 0	35 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. MEMB. FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO		
E-B	-294 / 0	0.0 0.0 0.11 (4)	7.81	
A-B	0 / 22	-77.4 -77.4 0.09 (1)	10.00	
B-C	-17 / 0	-77.4 -77.4 0.16 (1)	6.25	
E-D	0 / 0	-17.5 -17.5 0.13 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.0	PSF
TOTAL LOAD	=	33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.03")

CSI: TC=0.16/1.00 (B-C:1), BC=0.13/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SSI=0.14/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)	(PLI)	(PSI)	(PLI)	(PSI)	(PLI)
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



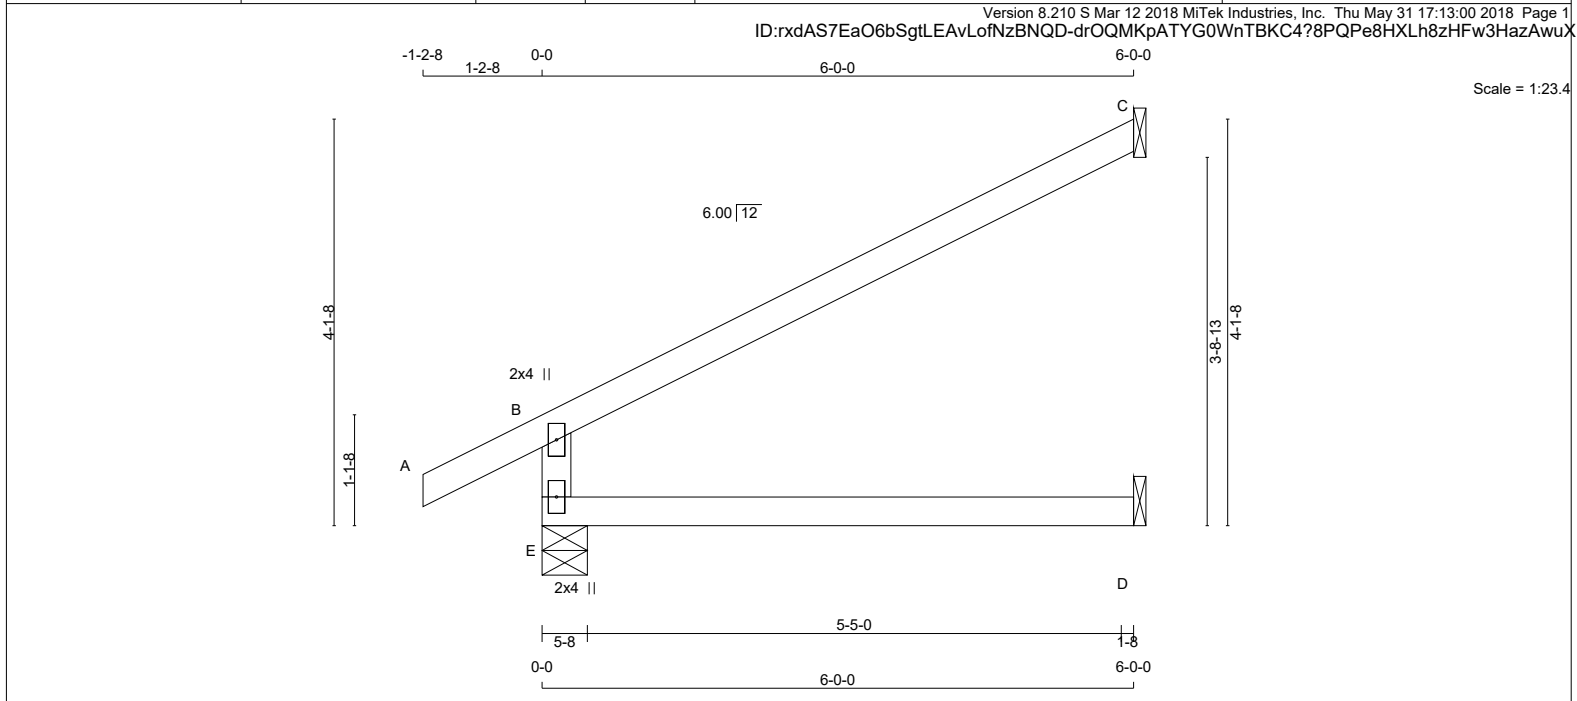

TOTAL WEIGHT = 10 X 17 = 169 lb [M][F]

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
E	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
E	450	0	450	0	5-8	5-8
C	174	0	174	0	1-8	1-8
D	43	0	48	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C , D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS				
		COMBINED	SNOW	LIVE	PERM.LIVE	WIND
E	314	234 / 0	0 / 0	0 / 0	0 / 0	80 / 0
C	118	105 / 0	0 / 0	0 / 0	0 / 0	14 / 0
D	35	0 / 0	0 / 0	0 / 0	0 / 0	35 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

MEMB.	CHORDS			WEBS		
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORZ. LOAD (LC)	MAX. MEMB. UNBRACED LENGTH	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORZ. LOAD (LC)
FR-TO		FROM	TO			
E-B	-389 / 0	0.0	0.0	0.11 (4)	7.81	
A-B	0 / 22	-77.4	-77.4	0.09 (1)	10.00	
B-C	-26 / 0	-77.4	-77.4	0.36 (1)	6.25	
E-D	0 / 0	-17.5	-17.5	0.13 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.03")

CSI: TC=0.36/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.22 (B) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



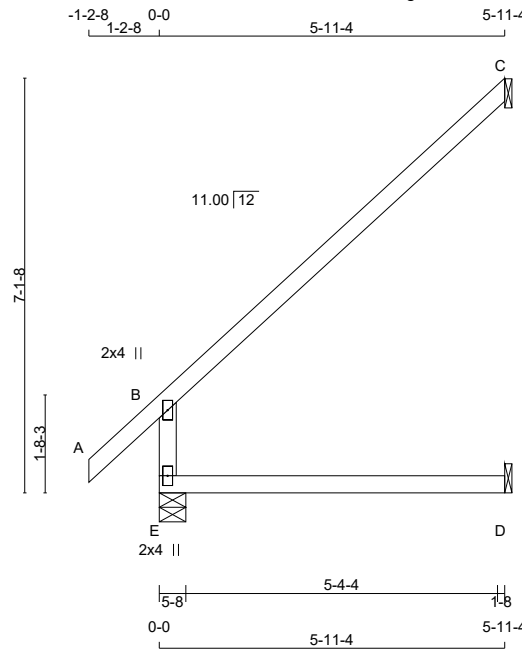

TOTAL WEIGHT = 4 X 20 = 78 lb

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
E	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
E	448	0	448	0	5-8	5-8
C	172	0	172	0	1-8	1-8
D	44	0	50	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS				
		COMBINED	SNOW	LIVE	PERM. LIVE	WIND
E	312	234 / 0	0 / 0	0 / 0	0 / 0	78 / 0
C	117	104 / 0	0 / 0	0 / 0	0 / 0	13 / 0
D	35	0 / 0	0 / 0	0 / 0	0 / 0	35 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		WEBS	
	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX	MAX. MEMB. FORCE (LBS)	FACTORED MAX CS1 (LC)
FR-TO		FROM TO			LENGTH FR-TO	
E-B	-388 / 0	0.0	0.0	0.10 (4)	7.81	
A-B	0 / 34	-77.4	-77.4	0.10 (1)	10.00	
B-C	-39 / 0	-77.4	-77.4	0.36 (1)	6.25	
E-D	0 / 0	-17.5	-17.5	0.13 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.03")

CSI: TC=0.36/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.29 (B) (INPUT = 0.90)
JSI METAL= 0.11 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



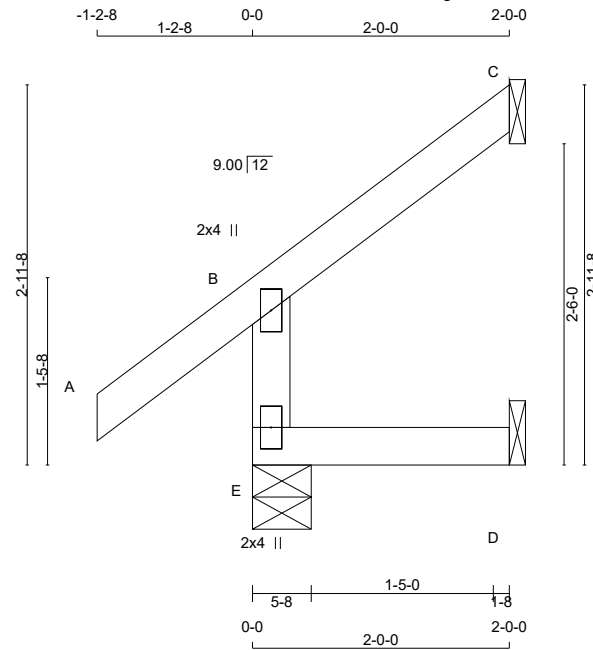

TOTAL WEIGHT = 3 X 8 = 25 lb [M]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	2.0	4.0
E	BMV1+p	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
E	216	0	216	0	5-8	5-8		
C	59	0	59	0	1-8	1-8		
D	16	0	18	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
E	149	118 / 0	0 / 0	0 / 0	0 / 0	31 / 0	0 / 0
C	40	35 / 0	0 / 0	0 / 0	0 / 0	5 / 0	0 / 0
D	13	0 / 0	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)
FR-TO		FROM TO		LENGTH FR-TO
E-B	-196 / 0	0.0 0.0 0.01 (4)	7.81	
A-B	0 / 30	-77.4 -77.4 0.09 (1)	10.00	
B-C	-11 / 0	-77.4 -77.4 0.05 (1)	6.25	
E-D	0 / 0	-17.5 -17.5 0.02 (4)	10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3 PSF
	DL =	3.0 PSF
BOT CH.	LL =	0.0 PSF
	DL =	7.0 PSF
TOTAL LOAD	=	33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.00")

CSI: TC=0.09/1.00 (A-B:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SSI=0.06/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.13 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



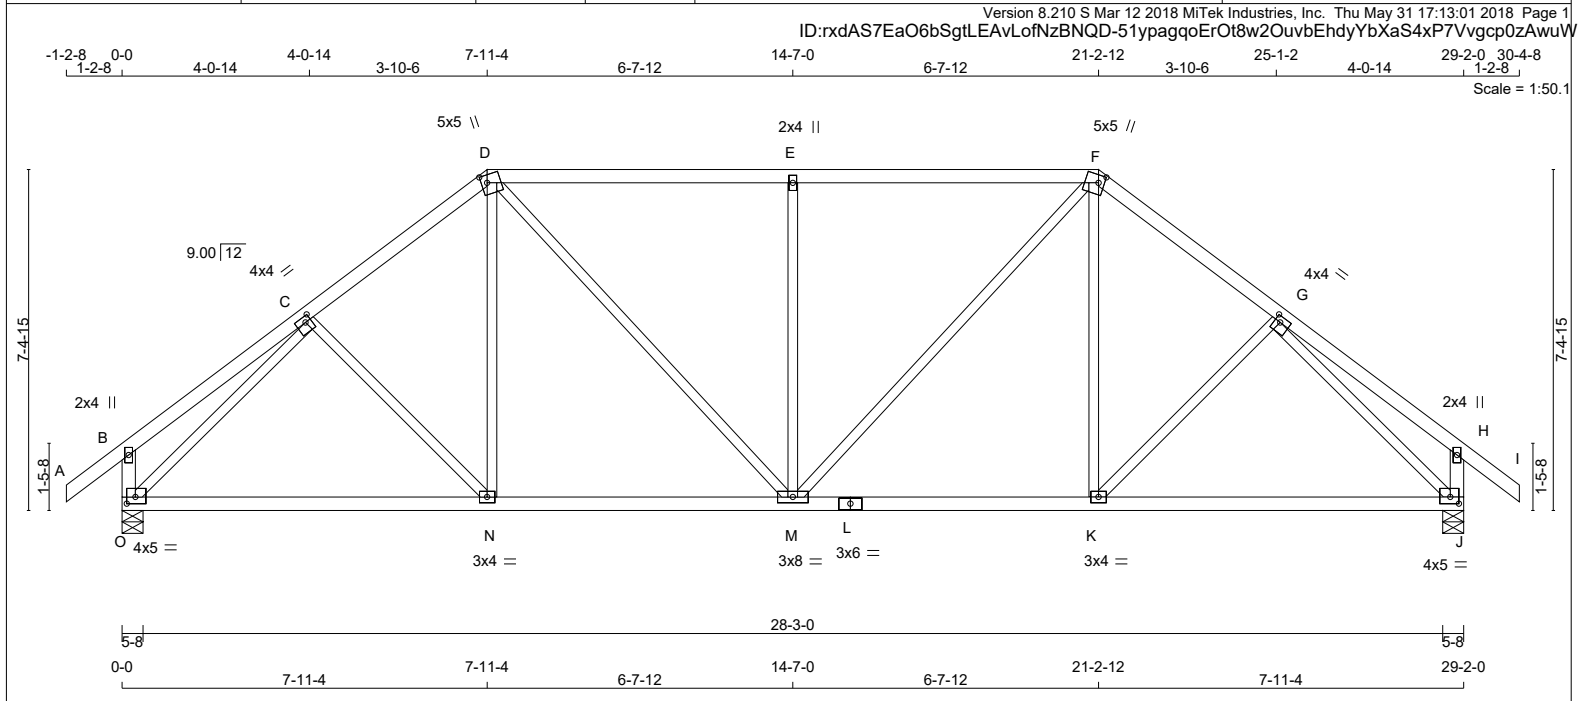

TOTAL WEIGHT = 127 lb [M][F]

N. L. G. A. RULES				BUILDING DESIGNER			
CHORDS		SIZE	LUMBER	DESCR.			
A - D	2x4	DRY	No.2	SPF			
B - F	2x4	DRY	No.2	SPF			
F - I	2x4	DRY	No.2	SPF			
O - B	2x4	DRY	No.2	SPF			
J - H	2x4	DRY	No.2	SPF			
O - L	2x4	DRY	No.2	SPF			
L - J	2x4	DRY	No.2	SPF			
ALL WEBS 2x3 DRY No.2				SPF			
EXCEPT							
DRY: SEASONED LUMBER.							


PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0	4.0	
C	TMWW-t	MT20	4.0	4.0	1.50	1.50
D	TTWW+m	MT20	5.0	5.0	2.00	1.50
E	TMW+w	MT20	2.0	4.0		
F	TTWW+m	MT20	5.0	5.0	2.00	1.50
G	TMWW-t	MT20	4.0	4.0	1.50	1.50
H	TMV+p	MT20	2.0	4.0		
J	BMVW1-t	MT20	4.0	5.0	1.75	2.25
K	BMWW-t	MT20	3.0	4.0		
L	BS-t	MT20	3.0	6.0		
M	BMWWW-t	MT20	3.0	8.0		
N	BMWW-t	MT20	3.0	4.0		
O	BMVW1-t	MT20	4.0	5.0	1.75	2.25

CHORDS				WEBS			
MEMB.		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LOAD LC1 (LC)	MAX. UNBRAC LENGTH	MEMB. MAX. FACTORED FORCE (LBS) MAX. CSI (LC)	
FR-TO			FROM TO			FR-TO	
A-B	0 / 30	-77.4	-77.4	0.09 (1)	10.00	C-N	-37 / 41 0.02 (1)
B-C	0 / 20	-77.4	-77.4	0.19 (1)	10.00	N-D	0 / 178 0.05 (4)
C-D	-1447 / 0	-77.4	-77.4	0.17 (1)	5.28	D-M	0 / 495 0.11 (1)
D-E	-1480 / 0	-77.4	-77.4	0.48 (1)	4.81	M-E	-631 / 0 0.62 (1)
E-F	-1480 / 0	-77.4	-77.4	0.48 (1)	4.81	M-F	0 / 495 0.11 (1)
F-G	-1447 / 0	-77.4	-77.4	0.17 (1)	5.28	K-F	0 / 178 0.05 (4)
G-H	0 / 20	-77.4	-77.4	0.19 (1)	10.00	K-G	-37 / 41 0.02 (1)
H-I	0 / 30	-77.4	-77.4	0.09 (1)	10.00	O-C	-1678 / 0 0.90 (1)
O-B	-219 / 0	0.0	0.0	0.02 (1)	7.81	G-J	-1678 / 0 0.90 (1)
J-H	-219 / 0	0.0	0.0	0.02 (1)	7.81		
O-N	0 / 1165	-17.5	-17.5	0.34 (4)	10.00		
N-M	0 / 1141	-17.5	-17.5	0.34 (4)	10.00		
M-L	0 / 1141	-17.5	-17.5	0.34 (4)	10.00		
L-K	0 / 1141	-17.5	-17.5	0.34 (4)	10.00		
K-J	0 / 1165	-17.5	-17.5	0.34 (4)	10.00		

DESIGN CRITERIA			
SPECIFIED LOADS:			
TOP CH.	LL	=	23.3 PSF
	DL	=	3.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.0 PSF
TOTAL LOAD	=	33.3	PSF
SPACING = 24.0 IN. C/C			
LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM			
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010			
THIS DESIGN COMPLIES WITH:			
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014			
- CSA 086-09			
- TPIC 2011			
(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD			
ALLOWABLE DEFL.(LL)= L/360 (0.97")			
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.06")			
ALLOWABLE DEFL.(TL)= L/360 (0.97")			
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.14")			
CSI: TC=0.48/1.00 (D-E:1) , BC=0.34/1.00 (K-M:4) , WB=0.90/1.00 (G-J:1) , SSI=0.25/1.00 (D-E:1)			
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10			
COMP=1.10 SHEAR=1.10 TENS= 1.10			
COMPANION LIVE LOAD FACTOR = 0.50			
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .			
NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX MIN
MT20	618	354	1667 822 2284 1656
PLATE PLACEMENT TOL. = 0.250 inches			
PLATE ROTATION TOL. = 5.0 Deg.			
JSI GRIP= 0.85 (G) (INPUT = 0.90)			
JSI METAL= 0.62 (C) (INPUT = 1.00)			

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



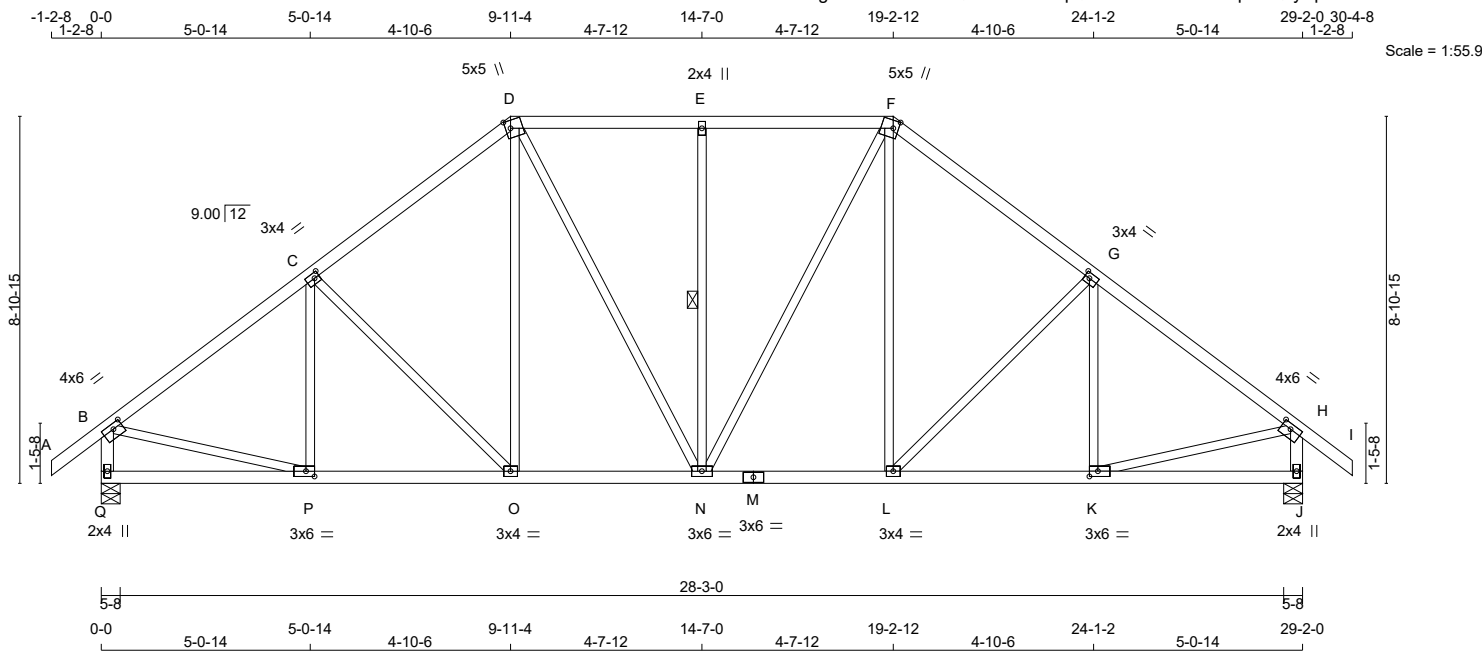

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
Q - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
Q - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW-t	MT20	4.0	6.0 1.50 2.75
C	TMWW-t	MT20	3.0	4.0 1.50 1.50
D	TTWW+m	MT20	5.0	5.0 2.25 1.50
E	TMW+w	MT20	2.0	4.0
F	TTWW+m	MT20	5.0	5.0 2.25 1.50
G	TMWW-t	MT20	3.0	4.0 1.50 1.50
H	TMVW-t	MT20	4.0	6.0 1.50 2.75
J	BMV1+p	MT20	2.0	4.0
K	BMWW-t	MT20	3.0	6.0 1.50 2.50
L	BMWW-t	MT20	3.0	4.0
M	BS-t	MT20	3.0	6.0
N	BMWWW-t	MT20	3.0	6.0
O	BMWW-t	MT20	3.0	4.0
P	BMWW-t	MT20	3.0	6.0 1.50 2.50
Q	BMV1+p	MT20	2.0	4.0



DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
Q	1484	0	1484	0	0	5-8	5-8
J	1484	0	1484	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
Q	1039	740 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0
J	1039	740 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.07 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 - 1x4 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N. DBS = 20-0-0. CBF = 54 LBS.

DBS = DIAGONAL BRACE SPACING (MAX). CBF = CUMULATIVE BRACING FORCE (PER BRACE). FASTEN LATERAL BRACE(S) USING (0.122"x3") SPIRAL NAILS : 1 NAIL FOR 2x3 BRACE(S), 2 FOR 1x4, 2x4, 2x5, 3 FOR 2x6, 4 FOR 2x8, 5 FOR 2x10, AND 6 FOR 2x12.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 30	-77.4 -77.4	0.09 (1)	10.00	P-C	-178 / 31	0.07 (1)
B-C	-1508 / 0	-77.4 -77.4	0.28 (1)	5.07	C-O	-244 / 0	0.23 (1)
C-D	-1349 / 0	-77.4 -77.4	0.27 (1)	5.30	O-D	0 / 256	0.06 (1)
D-E	-1196 / 0	-77.4 -77.4	0.22 (1)	5.60	D-N	0 / 291	0.07 (1)
E-F	-1196 / 0	-77.4 -77.4	0.22 (1)	5.60	N-E	-434 / 0	0.22 (1)
F-G	-1349 / 0	-77.4 -77.4	0.27 (1)	5.30	N-F	0 / 291	0.07 (1)
G-H	-1508 / 0	-77.4 -77.4	0.28 (1)	5.07	L-F	0 / 256	0.06 (1)
H-I	0 / 30	-77.4 -77.4	0.09 (1)	10.00	L-G	-244 / 0	0.23 (1)
Q-B	-1446 / 0	0.0 0.0	0.15 (1)	6.80	K-G	-178 / 31	0.07 (1)
J-H	-1446 / 0	0.0 0.0	0.15 (1)	6.80	B-P	0 / 1258	0.28 (1)
					K-H	0 / 1258	0.28 (1)
Q-P	0 / 0	-17.5 -17.5	0.10 (4)	10.00			
P-O	0 / 1228	-17.5 -17.5	0.24 (1)	10.00			
O-N	0 / 1058	-17.5 -17.5	0.21 (1)	10.00			
N-M	0 / 1058	-17.5 -17.5	0.21 (1)	10.00			
M-L	0 / 1058	-17.5 -17.5	0.21 (1)	10.00			
L-K	0 / 1228	-17.5 -17.5	0.24 (1)	10.00			
K-J	0 / 0	-17.5 -17.5	0.10 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.0	PSF
TOTAL LOAD	=	33.3	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL)= L/999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL)= L/999 (0.09")

CSI: TC=0.28/1.00 (G-H:1), BC=0.24/1.00 (O-P:1), WB=0.28/1.00 (B-P:1), SSI=0.17/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (N) (INPUT = 0.90)
JSI METAL= 0.42 (B) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



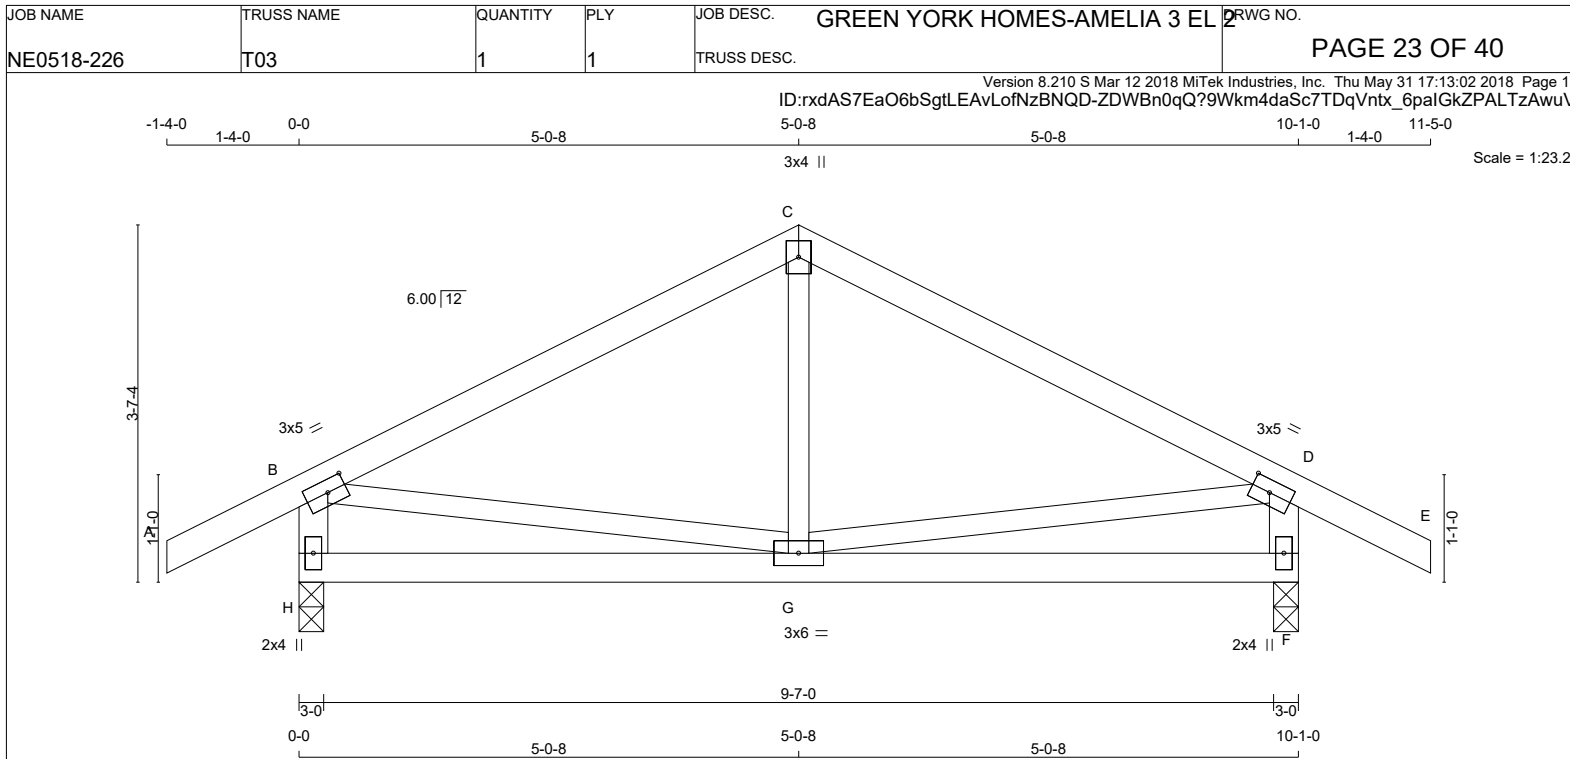

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
H - B	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	3.0	5.0	1.50	2.25
C	TTW+p	MT20	3.0	4.0		
D	TMVW-t	MT20	3.0	5.0	1.50	2.25
F	BMV1+p	MT20	2.0	4.0		
G	BMVW-t	MT20	3.0	6.0		
H	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ UPLIFT		
H	586	0	586	0	3-0	3-0
F	586	0	586	0	3-0	3-0

UNFACTORED REACTIONS

	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	409	300 / 0	0 / 0	0 / 0	0 / 0	109 / 0	0 / 0
F	409	300 / 0	0 / 0	0 / 0	0 / 0	109 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX		MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED MAX	
			FROM	TO				CSI (LC)	CSI (LC)
FR-TO									
A-B	0 / 24	-77.4	-77.4	0.11 (1)	10.00	G-C	-10 / 84	0.03 (4)	
B-C	-425 / 0	-77.4	-77.4	0.25 (1)	6.25	B-G	0 / 385	0.09 (1)	
C-D	-425 / 0	-77.4	-77.4	0.25 (1)	6.25	G-D	0 / 385	0.09 (1)	
D-E	0 / 24	-77.4	-77.4	0.11 (1)	10.00				
H-B	-552 / 0	0.0	0.0	0.06 (1)	7.81				
F-D	-552 / 0	0.0	0.0	0.06 (1)	7.81				
H-G	0 / 0	-17.5	-17.5	0.12 (4)	10.00				
G-F	0 / 0	-17.5	-17.5	0.12 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP	CH.	LL	=	23.3	PSF
		DL	=	3.0	PSF
BOT	CH.	LL	=	0.0	PSF
		DL	=	7.0	PSF
TOTAL		LOAD	=	33.3	PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.34")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.34")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.25/1.00 (B-C:1), BC=0.12/1.00 (G-H:4), WB=0.09/1.00 (D-G:1), SSI=0.14/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.79 (G) (INPUT = 0.90)
JSI METAL= 0.17 (D) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



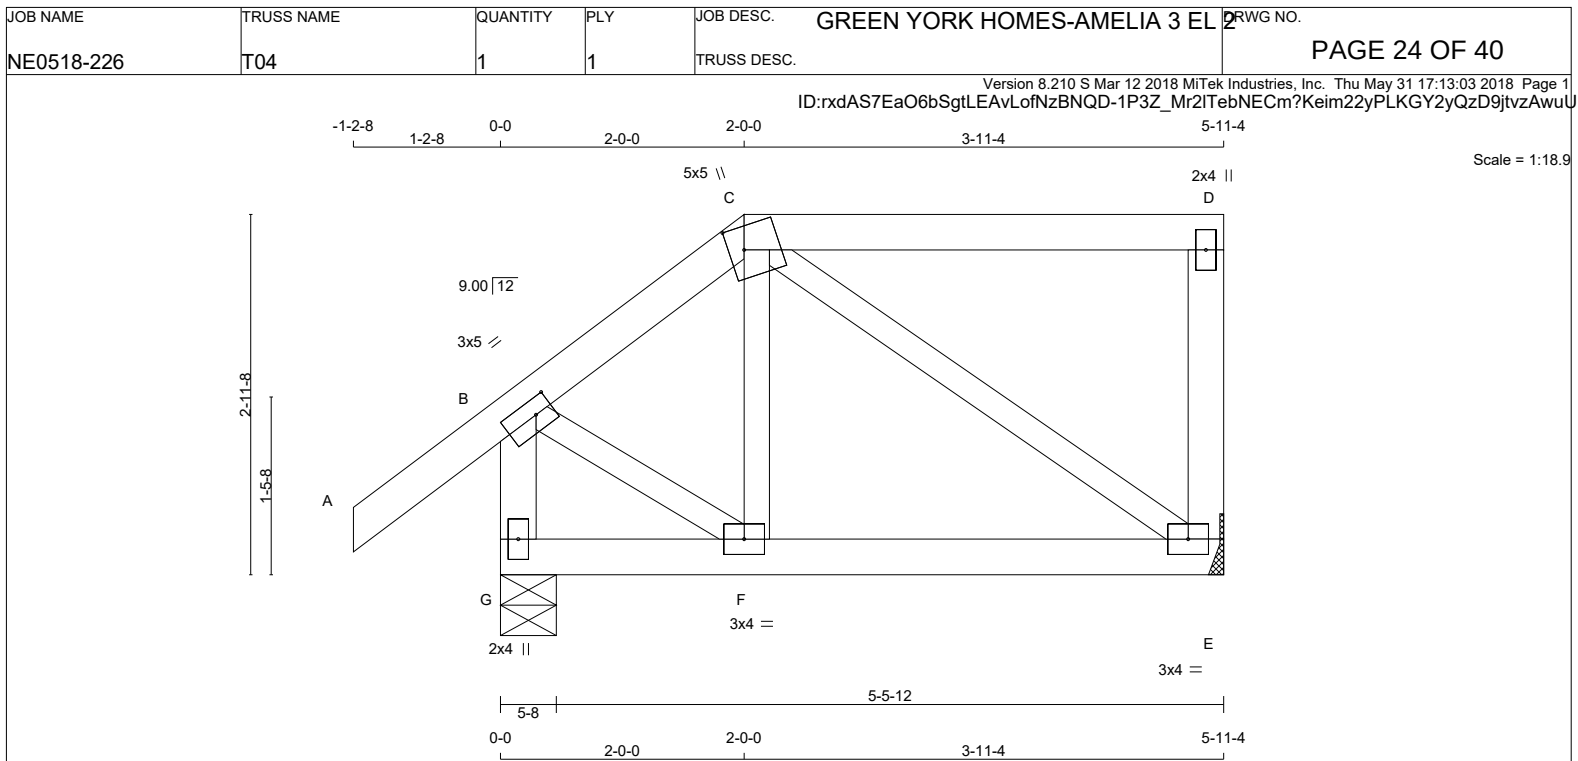

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF
G - B	2x4	DRY	No.2	SPF
G - E	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	3.0	5.0	1.50	1.75
C	TTWW+m	MT20	5.0	5.0	2.25	1.50
D	TMV+p	MT20	2.0	4.0		
E	BMVW1-t	MT20	3.0	4.0		
F	BMVW-t	MT20	3.0	4.0		
G	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
E	282	282	MECHANICAL	5-8
G	382	382	MECHANICAL	5-8

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT E TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	198	138 / 0	0 / 0	0 / 0	0 / 0	59 / 0	0 / 0
G	266	199 / 0	0 / 0	0 / 0	0 / 0	67 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	MAX. UNBRACED LENGTH	MEMB. FORCE (LBS)	FACTORED MAX (LC)
FR-TO		FROM	TO			
A-B	0 / 30	-77.4	-77.4 0.09 (1)	10.00	F-C	-15 / 49 0.02 (4)
B-C	-189 / 0	-77.4	-77.4 0.05 (1)	6.25	C-E	-181 / 0 0.06 (1)
C-D	0 / 0	-77.4	-77.4 0.20 (1)	10.00	B-F	0 / 171 0.04 (1)
E-D	-152 / 0	0.0	0.0 0.02 (1)	7.81		
G-B	-373 / 0	0.0	0.0 0.04 (1)	7.81		
G-F	0 / 0	-17.5	-17.5 0.05 (4)	10.00		
F-E	0 / 150	-17.5	-17.5 0.07 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
DL =	3.0	PSF	
BOT CH.	LL =	0.0	PSF
DL =	7.0	PSF	
TOTAL LOAD =	33.3	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.20/1.00 (C-D:1), BC=0.07/1.00 (E-F:4), WB=0.06/1.00 (C-E:1), SSI=0.12/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.31 (B) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



ID: rxdAS7EaO6bSgtLEAvLofNzBNQD-1P3Z_Mr2ITebNECm?Keim22w8LDjY1IQzD9jtvzAwuU

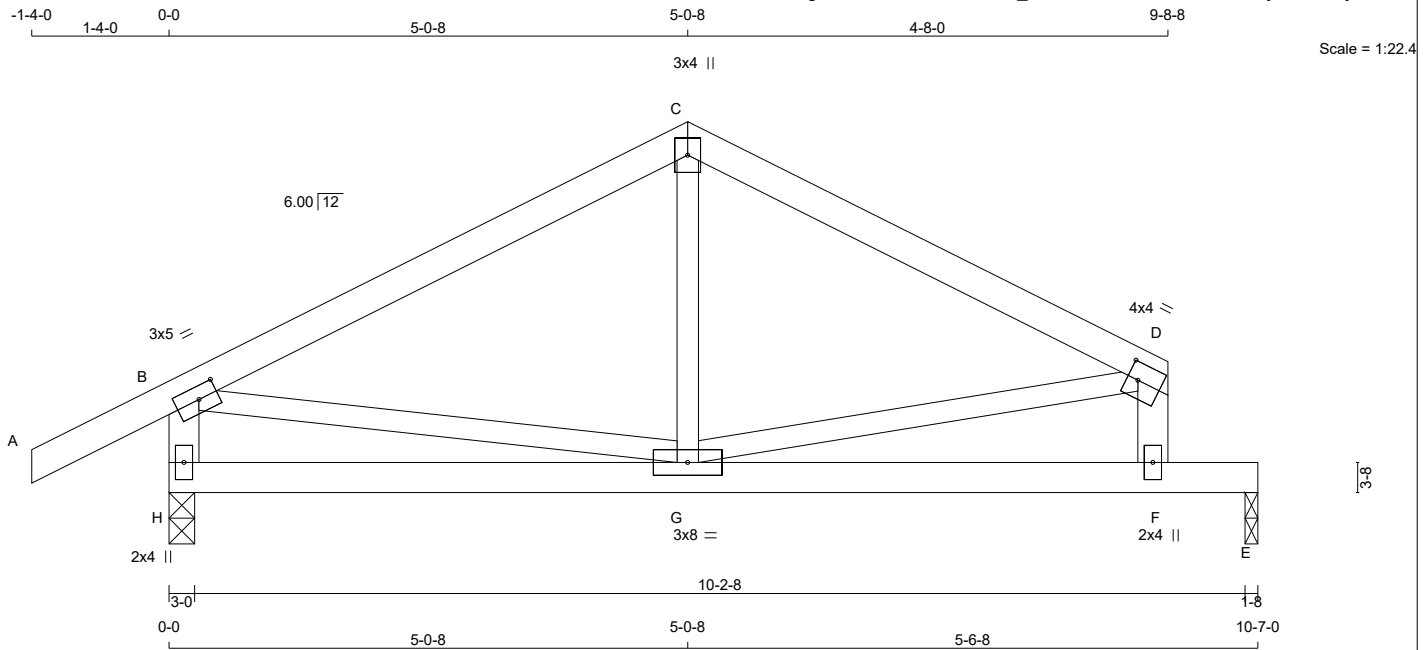

TOTAL WEIGHT = 2 X 38 = 76 lb [M]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
H - B	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
H - E	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	3.0	5.0	1.50	2.25
C	TTW+p	MT20	3.0	4.0		
D	TMVW-t	MT20	4.0	4.0	2.00	1.25
F	BMV+p	MT20	2.0	4.0		
G	BMWW-t	MT20	3.0	8.0		
H	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
H	610	0	610	0	3-0	3-0
E	502	0	502	0	1-8	1-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	426	312 / 0	0 / 0	0 / 0	0 / 0	114 / 0	0 / 0
E	352	246 / 0	0 / 0	0 / 0	0 / 0	106 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 24	-77.4 -77.4	0.11 (1)	10.00	G-C	0 / 103	0.04 (4)
B-C	-497 / 0	-77.4 -77.4	0.35 (1)	6.25	B-G	0 / 450	0.10 (1)
C-D	-497 / 0	-77.4 -77.4	0.30 (1)	6.25	G-D	0 / 454	0.10 (1)
H-B	-594 / 0	0.0 0.0	0.06 (1)	7.81			
F-D	-494 / 0	0.0 0.0	0.05 (1)	7.81			
H-G	0 / 0	-17.5 -17.5	0.19 (1)	10.00			
G-F	0 / 0	-17.5 -17.5	0.55 (1)	10.00			
F-E	0 / 0	-94.9 -94.9	0.55 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
DL	=	3.0	PSF	
BOT CH.	LL	=	0.0	PSF
DL	=	7.0	PSF	
TOTAL LOAD	=	33.3	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.11")
ALLOWABLE DEFL.(TL)= L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/ 631 (0.20")

CSI: TC=0.35/1.00 (B-C:1) , BC=0.55/1.00 (F-G:1) , WB=0.10/1.00 (D-G:1) , SSI=0.39/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.80 (D) (INPUT = 0.90)
JSI METAL= 0.22 (D) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



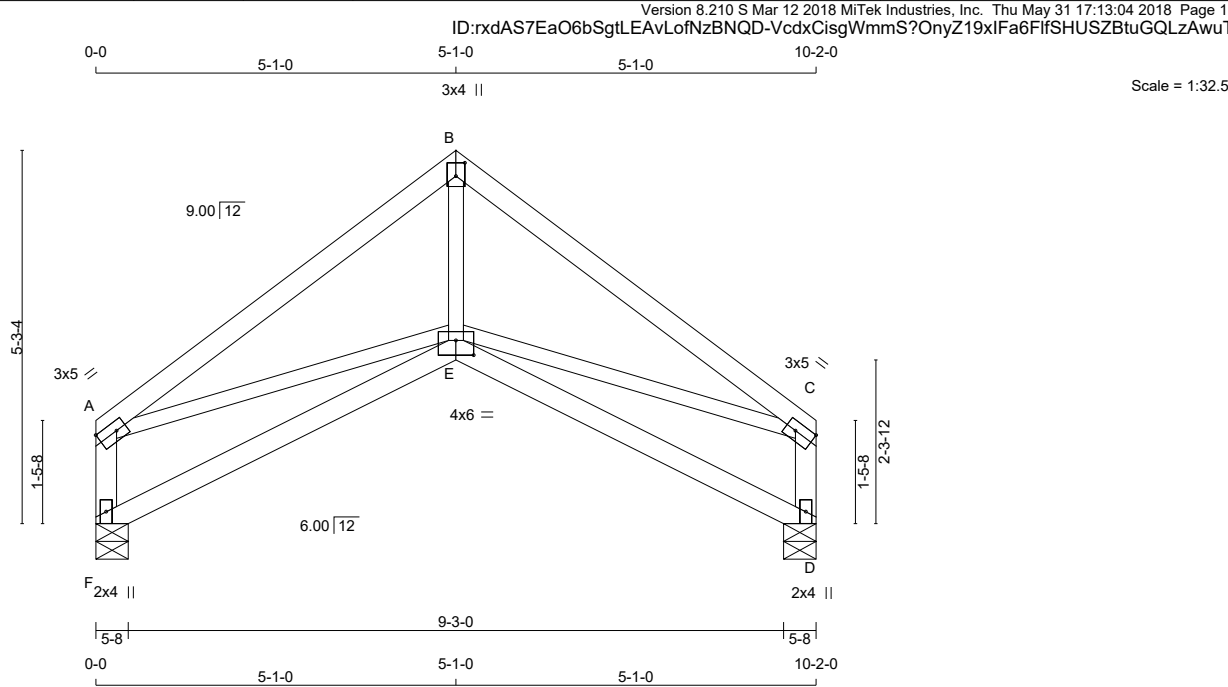

TOTAL WEIGHT = 2 X 41 = 81 lb [M][F]

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
F - A	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - E	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DESCR.
SPF
SPF
SPF
SPF
SPF
SPF

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	3.0	5.0	1.50	Edge
B	TTW+p	MT20	3.0	4.0	2.25	1.50
C	TMVW-t	MT20	3.0	5.0	1.50	Edge
D	BMV1+p	MT20	2.0	4.0		
E	BBWWV-p	MT20	4.0	6.0	2.50	3.00
F	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
F	482	0	482	0	5-8	5-8
D	482	0	482	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	338	237 / 0	0 / 0	0 / 0	0 / 0	102 / 0	0 / 0
D	338	237 / 0	0 / 0	0 / 0	0 / 0	102 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS						WEBS					
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FORCE (LBS)	FACTORED MAX CSI (LC)			
FR-TO		FROM	TO			FR-TO					
A-B	-586 / 0	-77.4	-77.4	0.26 (1)	6.25	E-B	0 / 310	0.07 (1)			
B-C	-586 / 0	-77.4	-77.4	0.26 (1)	6.25	A-E	0 / 482	0.11 (1)			
F-A	-438 / 0	0.0	0.0	0.05 (1)	7.81	E-C	0 / 482	0.11 (1)			
D-C	-438 / 0	0.0	0.0	0.05 (1)	7.81						
F-E	0 / 0	-17.5	-17.5	0.13 (4)	10.00						
E-D	0 / 0	-17.5	-17.5	0.13 (4)	10.00						

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	PSF
DL	23.3	PSF
BOT CH.	LL	PSF
DL	0.0	PSF
DL	7.0	PSF
TOTAL LOAD	33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.34")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.34")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.26/1.00 (A-B:1), BC=0.13/1.00 (D-E:4), WB=0.11/1.00 (A-E:1), SSI=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.69 (E) (INPUT = 0.90)
JSI METAL= 0.21 (A) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



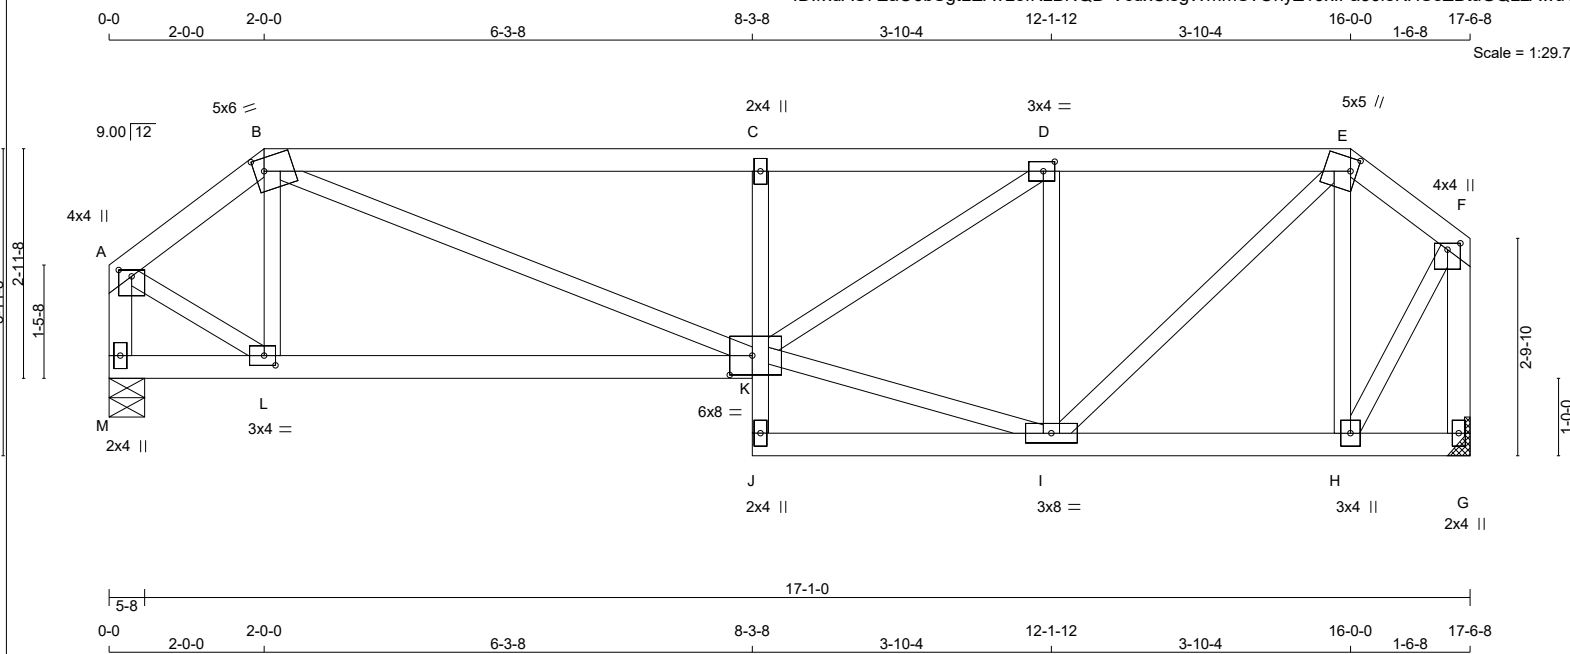

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	No.2
B - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
M - A	2x4	DRY	No.2
G - F	2x4	DRY	No.2
M - K	2x4	DRY	No.2
J - C	2x3	DRY	No.2
J - G	2x4	DRY	No.2

ALL WEBS EXCEPT
2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.00	2.00
B	TTWW-m	MT20	5.0	6.0	2.00	1.50
C	TMV+p	MT20	2.0	4.0		
D	TMWW-t	MT20	3.0	4.0	1.50	1.75
E	TTWW+m	MT20	5.0	5.0	2.00	1.00
F	TMVW+p	MT20	4.0	4.0	1.00	2.00
G	BMV1+p	MT20	2.0	4.0		
H	BMWW+t	MT20	3.0	4.0		
I	BMWWW-t	MT20	3.0	8.0		
J	BMV+p	MT20	2.0	4.0		
K	BVMWWW-I	MT20	6.0	8.0	3.00	3.50
L	BMWW-t	MT20	3.0	4.0	1.50	1.75
M	BMV1+p	MT20	2.0	4.0		



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT VERT	DOWN	IN-SX	IN-SX
M 832	0	5-8	5-8
G 832	0	MECHANICAL	

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT G TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
M 584	408 / 0 0 / 0 0 / 0 0 / 0 175 / 0 0 / 0
G 584	408 / 0 0 / 0 0 / 0 0 / 0 175 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.86 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED UNBRACED LENGTH FR-TO	MAX. FACTORED CSI (LC)
FR-TO		FROM	TO				
A-B	-745 / 0	-77.4	-77.4 0.06 (1)	6.25	L-B	-202 / 25	0.04 (1)
B-C	-1464 / 0	-77.4	-77.4 0.46 (1)	4.86	B-K	0 / 951	0.21 (1)
C-D	-1456 / 0	-77.4	-77.4 0.40 (1)	4.91	K-I	0 / 879	0.20 (1)
D-E	-871 / 0	-77.4	-77.4 0.17 (1)	6.25	K-D	0 / 718	0.16 (1)
E-F	-427 / 0	-77.4	-77.4 0.03 (1)	6.25	I-D	-671 / 0	0.16 (1)
M-A	-846 / 0	0.0	0.0 0.09 (1)	7.81	I-E	0 / 750	0.17 (1)
G-F	-828 / 0	0.0	0.0 0.12 (1)	7.81	H-E	-453 / 0	0.11 (1)
					A-L	0 / 673	0.15 (1)
					H-F	0 / 613	0.14 (1)
M-L	0 / 0	-17.5	-17.5 0.16 (4)	10.00			
L-K	0 / 585	-17.5	-17.5 0.20 (4)	10.00			
J-K	0 / 29	0.0	0.0 0.06 (1)	10.00			
K-C	-482 / 0	0.0	0.0 0.07 (1)	7.81			
J-I	0 / 21	-17.5	-17.5 0.06 (4)	10.00			
I-H	0 / 326	-17.5	-17.5 0.08 (4)	10.00			
H-G	0 / 0	-17.5	-17.5 0.03 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
DL = 3.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.0	PSF	
TOTAL LOAD = 33.3	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.58")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (0.58")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.10")

CSI: TC=0.46/1.00 (B-C:1), BC=0.20/1.00 (K-L:4), WB=0.21/1.00 (B-K:1), SSI=0.23/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (D) (INPUT = 0.90)
JSI METAL= 0.25 (B) (INPUT = 1.00)

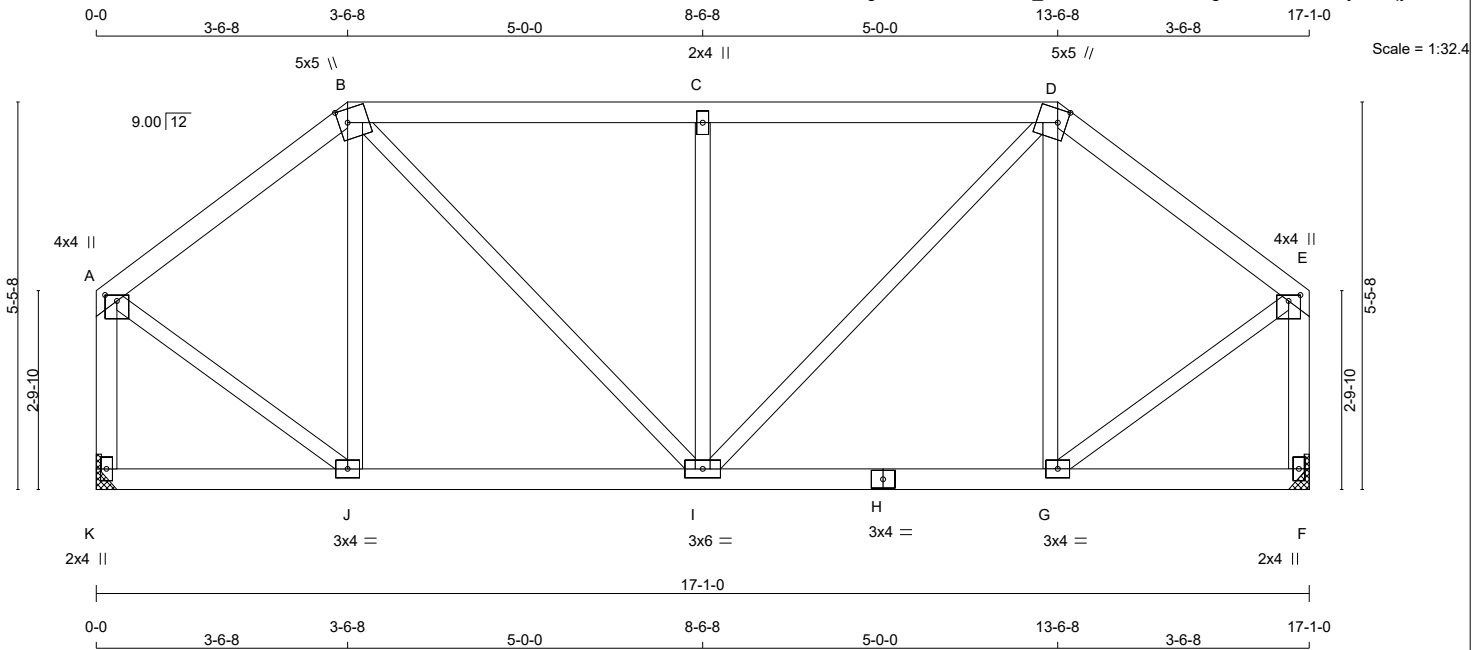

TOTAL WEIGHT = 76 lb [M]

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY No.2	SPF
B - D	2x4	DRY No.2	SPF
D - E	2x4	DRY No.2	SPF
K - A	2x4	DRY No.2	SPF
F - E	2x4	DRY No.2	SPF
K - H	2x4	DRY No.2	SPF
H - F	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.00	2.00
B	TTWW+m	MT20	5.0	5.0	2.25	1.50
C	TMW+w	MT20	2.0	4.0		
D	TTWW+m	MT20	5.0	5.0	2.25	1.50
E	TMVW+p	MT20	4.0	4.0	1.00	2.00
F	BMV1+p	MT20	2.0	4.0		
G	BMWW-t	MT20	3.0	4.0		
H	BS-t	MT20	3.0	4.0		
I	BMWWW-t	MT20	3.0	6.0		
J	BMWW-t	MT20	3.0	4.0		
K	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT		VERT	HORZ	UPLIFT	IN-SX
K		810	0	0	MECHANICAL
F		810	0	0	MECHANICAL

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT K, F TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
K	569	398 / 0	0 / 0	0 / 0	0 / 0	171 / 0	0 / 0
F	569	398 / 0	0 / 0	0 / 0	0 / 0	171 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)	MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)
FR-TO		FROM	TO	UNBRAC LENGTH	FR-TO		
A-B	-569 / 0	-77.4	-77.4 0.17 (1)	6.25	J-B	-223 / 0	0.10 (1)
B-C	-720 / 0	-77.4	-77.4 0.33 (1)	6.25	B-I	0 / 388	0.09 (1)
C-D	-720 / 0	-77.4	-77.4 0.33 (1)	6.25	I-C	-474 / 0	0.21 (1)
D-E	-569 / 0	-77.4	-77.4 0.17 (1)	6.25	I-D	0 / 388	0.09 (1)
K-A	-787 / 0	0.0	0.0 0.12 (1)	7.81	G-D	-223 / 0	0.10 (1)
F-E	-787 / 0	0.0	0.0 0.12 (1)	7.81	A-J	0 / 548	0.12 (1)
					G-E	0 / 548	0.12 (1)
K-J	0 / 0	-17.5	-17.5 0.07 (4)	10.00			
J-I	0 / 449	-17.5	-17.5 0.12 (1)	10.00			
I-H	0 / 449	-17.5	-17.5 0.12 (1)	10.00			
H-G	0 / 449	-17.5	-17.5 0.12 (1)	10.00			
G-F	0 / 0	-17.5	-17.5 0.07 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.0	PSF
TOTAL LOAD	=	33.3	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.57")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.57")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.33/1.00 (B-C:1), BC=0.12/1.00 (I-J:1), WB=0.21/1.00 (C-I:1), SSI=0.19/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (B) (INPUT = 0.90)
JSI METAL= 0.17 (E) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



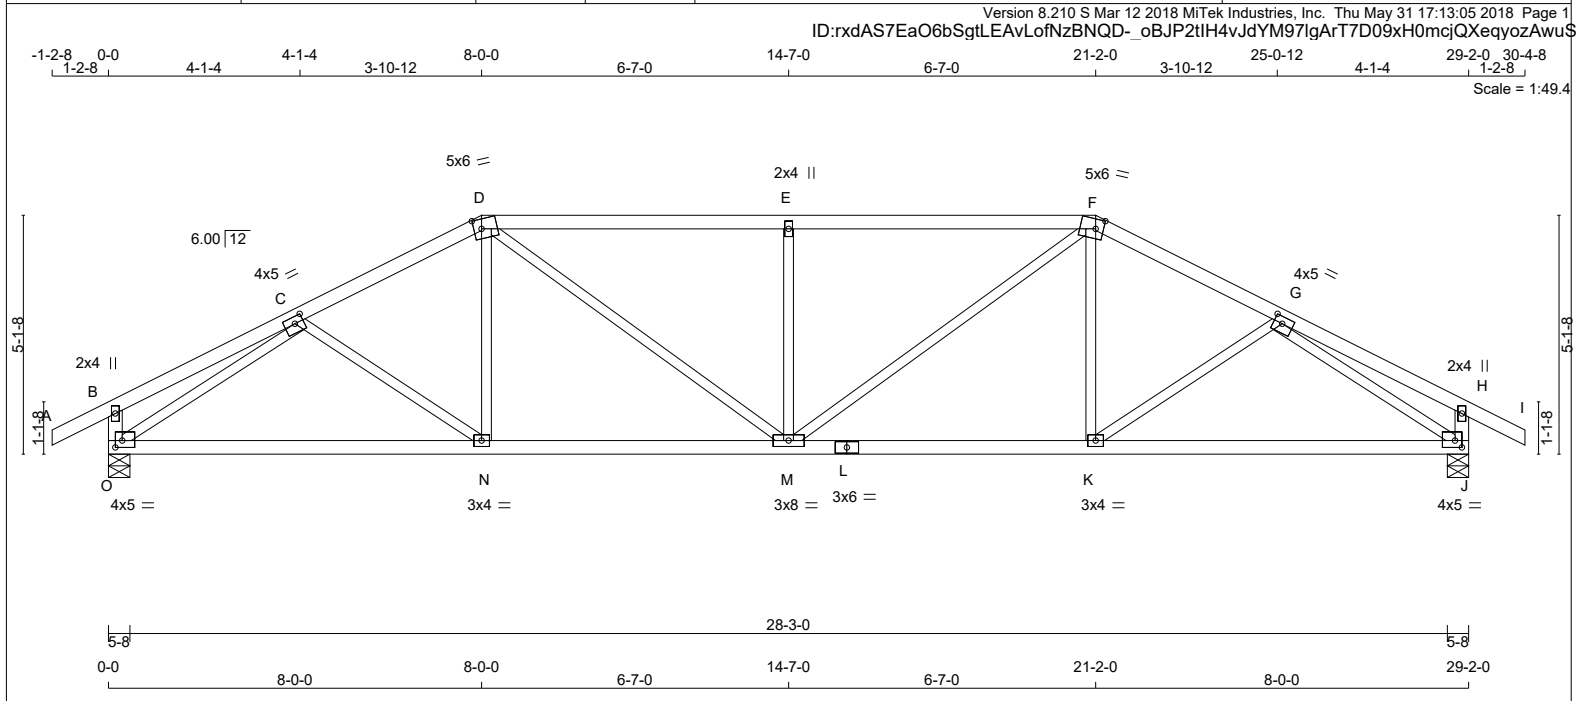

LUMBER N. L. G. A. RULES <table><tr><th>CHORDS</th><th>SIZE</th><th>DRY</th><th>LUMBER</th><th>DESCR.</th></tr><tr><td>A - D</td><td>2x4</td><td>DRY</td><td>No.2</td><td>SPF</td></tr><tr><td>D - F</td><td>2x4</td><td>DRY</td><td>No.2</td><td>SPF</td></tr><tr><td>F - I</td><td>2x4</td><td>DRY</td><td>No.2</td><td>SPF</td></tr><tr><td>O - B</td><td>2x4</td><td>DRY</td><td>No.2</td><td>SPF</td></tr><tr><td>J - H</td><td>2x4</td><td>DRY</td><td>No.2</td><td>SPF</td></tr><tr><td>O - L</td><td>2x4</td><td>DRY</td><td>No.2</td><td>SPF</td></tr><tr><td>L - J</td><td>2x4</td><td>DRY</td><td>No.2</td><td>SPF</td></tr></table> ALL WEBS 2x3 DRY No.2 SPF EXCEPT DRY: SEASONED LUMBER.					CHORDS	SIZE	DRY	LUMBER	DESCR.	A - D	2x4	DRY	No.2	SPF	D - F	2x4	DRY	No.2	SPF	F - I	2x4	DRY	No.2	SPF	O - B	2x4	DRY	No.2	SPF	J - H	2x4	DRY	No.2	SPF	O - L	2x4	DRY	No.2	SPF	L - J	2x4	DRY	No.2	SPF	DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS <table><tr><th rowspan="2">JT</th><th colspan="2">FACTORED GROSS REACTION</th><th colspan="2">MAXIMUM FACTORED GROSS REACTION</th><th rowspan="2">INPUT BRG</th><th rowspan="2">REQRD BRG</th></tr><tr><th>VERT</th><th>HORZ</th><th>DOWN</th><th>HORZ</th></tr><tr><td>O</td><td>1482</td><td>0</td><td>1482</td><td>0</td><td>5-8</td><td>5-8</td></tr><tr><td>J</td><td>1482</td><td>0</td><td>1482</td><td>0</td><td>5-8</td><td>5-8</td></tr></table> UNFACTORED REACTIONS <table><tr><th rowspan="2">JT</th><th colspan="2">1ST LCASE</th><th colspan="4">MAX./MIN. COMPONENT REACTIONS</th><th rowspan="2">SOIL</th></tr><tr><th>COMBINED</th><th>SNOW</th><th>LIVE</th><th>PERM.LIVE</th><th>WIND</th><th>DEAD</th></tr><tr><td>O</td><td>1038</td><td>739 / 0</td><td>0 / 0</td><td>0 / 0</td><td>0 / 0</td><td>299 / 0</td><td>0 / 0</td></tr><tr><td>J</td><td>1038</td><td>739 / 0</td><td>0 / 0</td><td>0 / 0</td><td>0 / 0</td><td>299 / 0</td><td>0 / 0</td></tr></table> BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.09 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) <table><tr><th colspan="4">CHORDS</th><th colspan="4">WEBS</th></tr><tr><th>MEMB.</th><th>MAX. FACTORED FORCE (LBS)</th><th>FACTORED VERT. LOAD (PLF)</th><th>MAX. FACTORED LC1 (LC)</th><th>MAX. UNBRACED LENGTH</th><th>MEMB.</th><th>MAX. FACTORED FORCE (LBS)</th><th>MAX. FACTORED LC1 (LC)</th></tr><tr><td>FR-TO</td><td></td><td>FROM</td><td>TO</td><td></td><td>FR-TO</td><td></td><td></td></tr><tr><td>A-B</td><td>0 / 22</td><td>-77.4</td><td>-77.4</td><td>0.09 (1)</td><td>10.00</td><td>C-N</td><td>-29 / 57 0.02 (4)</td></tr><tr><td>B-C</td><td>0 / 14</td><td>-77.4</td><td>-77.4</td><td>0.17 (1)</td><td>10.00</td><td>N-D</td><td>0 / 169 0.05 (4)</td></tr><tr><td>C-D</td><td>-1898 / 0</td><td>-77.4</td><td>-77.4</td><td>0.18 (1)</td><td>4.74</td><td>D-M</td><td>0 / 605 0.14 (1)</td></tr><tr><td>D-E</td><td>-2175 / 0</td><td>-77.4</td><td>-77.4</td><td>0.52 (1)</td><td>4.09</td><td>M-E</td><td>-626 / 0 0.24 (1)</td></tr><tr><td>E-F</td><td>-2175 / 0</td><td>-77.4</td><td>-77.4</td><td>0.52 (1)</td><td>4.09</td><td>M-F</td><td>0 / 605 0.14 (1)</td></tr><tr><td>F-G</td><td>-1898 / 0</td><td>-77.4</td><td>-77.4</td><td>0.18 (1)</td><td>4.74</td><td>K-F</td><td>0 / 169 0.05 (4)</td></tr><tr><td>G-H</td><td>0 / 14</td><td>-77.4</td><td>-77.4</td><td>0.17 (1)</td><td>10.00</td><td>K-G</td><td>-29 / 57 0.02 (4)</td></tr><tr><td>H-I</td><td>0 / 22</td><td>-77.4</td><td>-77.4</td><td>0.09 (1)</td><td>10.00</td><td>O-C</td><td>-2088 / 0 0.82 (1)</td></tr><tr><td>O-B</td><td>-223 / 0</td><td>0.0</td><td>0.0</td><td>0.02 (1)</td><td>7.81</td><td>G-J</td><td>-2088 / 0 0.82 (1)</td></tr><tr><td>J-H</td><td>-223 / 0</td><td>0.0</td><td>0.0</td><td>0.02 (1)</td><td>7.81</td><td></td><td></td></tr><tr><td>O-N</td><td>0 / 1708</td><td>-17.5</td><td>-17.5</td><td>0.41 (1)</td><td>10.00</td><td></td><td></td></tr><tr><td>N-M</td><td>0 / 1688</td><td>-17.5</td><td>-17.5</td><td>0.41 (1)</td><td>10.00</td><td></td><td></td></tr><tr><td>M-L</td><td>0 / 1688</td><td>-17.5</td><td>-17.5</td><td>0.41 (1)</td><td>10.00</td><td></td><td></td></tr><tr><td>L-K</td><td>0 / 1688</td><td>-17.5</td><td>-17.5</td><td>0.41 (1)</td><td>10.00</td><td></td><td></td></tr><tr><td>K-J</td><td>0 / 1708</td><td>-17.5</td><td>-17.5</td><td>0.41 (1)</td><td>10.00</td><td></td><td></td></tr></table>					JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG	VERT	HORZ	DOWN	HORZ	O	1482	0	1482	0	5-8	5-8	J	1482	0	1482	0	5-8	5-8	JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS				SOIL	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	O	1038	739 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0	J	1038	739 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0	CHORDS				WEBS				MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LC1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LC1 (LC)	FR-TO		FROM	TO		FR-TO			A-B	0 / 22	-77.4	-77.4	0.09 (1)	10.00	C-N	-29 / 57 0.02 (4)	B-C	0 / 14	-77.4	-77.4	0.17 (1)	10.00	N-D	0 / 169 0.05 (4)	C-D	-1898 / 0	-77.4	-77.4	0.18 (1)	4.74	D-M	0 / 605 0.14 (1)	D-E	-2175 / 0	-77.4	-77.4	0.52 (1)	4.09	M-E	-626 / 0 0.24 (1)	E-F	-2175 / 0	-77.4	-77.4	0.52 (1)	4.09	M-F	0 / 605 0.14 (1)	F-G	-1898 / 0	-77.4	-77.4	0.18 (1)	4.74	K-F	0 / 169 0.05 (4)	G-H	0 / 14	-77.4	-77.4	0.17 (1)	10.00	K-G	-29 / 57 0.02 (4)	H-I	0 / 22	-77.4	-77.4	0.09 (1)	10.00	O-C	-2088 / 0 0.82 (1)	O-B	-223 / 0	0.0	0.0	0.02 (1)	7.81	G-J	-2088 / 0 0.82 (1)	J-H	-223 / 0	0.0	0.0	0.02 (1)	7.81			O-N	0 / 1708	-17.5	-17.5	0.41 (1)	10.00			N-M	0 / 1688	-17.5	-17.5	0.41 (1)	10.00			M-L	0 / 1688	-17.5	-17.5	0.41 (1)	10.00			L-K	0 / 1688	-17.5	-17.5	0.41 (1)	10.00			K-J	0 / 1708	-17.5	-17.5	0.41 (1)	10.00			DESIGN CRITERIA SPECIFIED LOADS: <table><tr><th>TOP CH.</th><th>LL</th><th>PSF</th></tr><tr><td>DL</td><td>=</td><td>23.3</td></tr><tr><td>DL</td><td>=</td><td>3.0</td></tr><tr><th>BOT CH.</th><th>LL</th><th>PSF</th></tr><tr><td>DL</td><td>=</td><td>0.0</td></tr><tr><td>DL</td><td>=</td><td>7.0</td></tr><tr><td>TOTAL LOAD</td><td>=</td><td>33.3</td></tr></table> SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010 THIS DESIGN COMPLIES WITH: - PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014 - CSA 086-09 - TPIC 2011 (55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL)= L/360 (0.97") CALCULATED VERT. DEFL.(LL)= L/ 999 (0.11") ALLOWABLE DEFL.(TL)= L/360 (0.97") CALCULATED VERT. DEFL.(TL)= L/ 999 (0.19") CSI: TC=0.52/1.00 (D-E:1) , BC=0.41/1.00 (J-K:1) , WB=0.82/1.00 (G-J:1) , SSI=0.25/1.00 (D-E:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10 COMPANION LIVE LOAD FACTOR = 0.50 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT . NAIL VALUES <table><tr><th>PLATE</th><th>GRIP(DRY)</th><th>SHEAR</th><th>SECTION</th></tr><tr><td></td><td>(PSI)</td><td>(PLI)</td><td>(PLI)</td></tr><tr><td></td><td>MAX</td><td>MIN</td><td>MAX MIN</td></tr><tr><td>MT20</td><td>618</td><td>354</td><td>1667 822 2284 1656</td></tr></table> PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.89 (F) (INPUT = 0.90) JSI METAL= 0.61 (C) (INPUT = 1.00)					TOP CH.	LL	PSF	DL	=	23.3	DL	=	3.0	BOT CH.	LL	PSF	DL	=	0.0	DL	=	7.0	TOTAL LOAD	=	33.3	PLATE	GRIP(DRY)	SHEAR	SECTION		(PSI)	(PLI)	(PLI)		MAX	MIN	MAX MIN	MT20	618	354	1667 822 2284 1656
CHORDS	SIZE	DRY	LUMBER	DESCR.																																																																																																																																																																																																																																																																																														
A - D	2x4	DRY	No.2	SPF																																																																																																																																																																																																																																																																																														
D - F	2x4	DRY	No.2	SPF																																																																																																																																																																																																																																																																																														
F - I	2x4	DRY	No.2	SPF																																																																																																																																																																																																																																																																																														
O - B	2x4	DRY	No.2	SPF																																																																																																																																																																																																																																																																																														
J - H	2x4	DRY	No.2	SPF																																																																																																																																																																																																																																																																																														
O - L	2x4	DRY	No.2	SPF																																																																																																																																																																																																																																																																																														
L - J	2x4	DRY	No.2	SPF																																																																																																																																																																																																																																																																																														
JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG																																																																																																																																																																																																																																																																																												
	VERT	HORZ	DOWN	HORZ																																																																																																																																																																																																																																																																																														
O	1482	0	1482	0	5-8	5-8																																																																																																																																																																																																																																																																																												
J	1482	0	1482	0	5-8	5-8																																																																																																																																																																																																																																																																																												
JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS				SOIL																																																																																																																																																																																																																																																																																											
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD																																																																																																																																																																																																																																																																																												
O	1038	739 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0																																																																																																																																																																																																																																																																																											
J	1038	739 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0																																																																																																																																																																																																																																																																																											
CHORDS				WEBS																																																																																																																																																																																																																																																																																														
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LC1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LC1 (LC)																																																																																																																																																																																																																																																																																											
FR-TO		FROM	TO		FR-TO																																																																																																																																																																																																																																																																																													
A-B	0 / 22	-77.4	-77.4	0.09 (1)	10.00	C-N	-29 / 57 0.02 (4)																																																																																																																																																																																																																																																																																											
B-C	0 / 14	-77.4	-77.4	0.17 (1)	10.00	N-D	0 / 169 0.05 (4)																																																																																																																																																																																																																																																																																											
C-D	-1898 / 0	-77.4	-77.4	0.18 (1)	4.74	D-M	0 / 605 0.14 (1)																																																																																																																																																																																																																																																																																											
D-E	-2175 / 0	-77.4	-77.4	0.52 (1)	4.09	M-E	-626 / 0 0.24 (1)																																																																																																																																																																																																																																																																																											
E-F	-2175 / 0	-77.4	-77.4	0.52 (1)	4.09	M-F	0 / 605 0.14 (1)																																																																																																																																																																																																																																																																																											
F-G	-1898 / 0	-77.4	-77.4	0.18 (1)	4.74	K-F	0 / 169 0.05 (4)																																																																																																																																																																																																																																																																																											
G-H	0 / 14	-77.4	-77.4	0.17 (1)	10.00	K-G	-29 / 57 0.02 (4)																																																																																																																																																																																																																																																																																											
H-I	0 / 22	-77.4	-77.4	0.09 (1)	10.00	O-C	-2088 / 0 0.82 (1)																																																																																																																																																																																																																																																																																											
O-B	-223 / 0	0.0	0.0	0.02 (1)	7.81	G-J	-2088 / 0 0.82 (1)																																																																																																																																																																																																																																																																																											
J-H	-223 / 0	0.0	0.0	0.02 (1)	7.81																																																																																																																																																																																																																																																																																													
O-N	0 / 1708	-17.5	-17.5	0.41 (1)	10.00																																																																																																																																																																																																																																																																																													
N-M	0 / 1688	-17.5	-17.5	0.41 (1)	10.00																																																																																																																																																																																																																																																																																													
M-L	0 / 1688	-17.5	-17.5	0.41 (1)	10.00																																																																																																																																																																																																																																																																																													
L-K	0 / 1688	-17.5	-17.5	0.41 (1)	10.00																																																																																																																																																																																																																																																																																													
K-J	0 / 1708	-17.5	-17.5	0.41 (1)	10.00																																																																																																																																																																																																																																																																																													
TOP CH.	LL	PSF																																																																																																																																																																																																																																																																																																
DL	=	23.3																																																																																																																																																																																																																																																																																																
DL	=	3.0																																																																																																																																																																																																																																																																																																
BOT CH.	LL	PSF																																																																																																																																																																																																																																																																																																
DL	=	0.0																																																																																																																																																																																																																																																																																																
DL	=	7.0																																																																																																																																																																																																																																																																																																
TOTAL LOAD	=	33.3																																																																																																																																																																																																																																																																																																
PLATE	GRIP(DRY)	SHEAR	SECTION																																																																																																																																																																																																																																																																																															
	(PSI)	(PLI)	(PLI)																																																																																																																																																																																																																																																																																															
	MAX	MIN	MAX MIN																																																																																																																																																																																																																																																																																															
MT20	618	354	1667 822 2284 1656																																																																																																																																																																																																																																																																																															

LICENSED PROFESSIONAL ENGINEER

N.A. EL-MASRI

PROVINCE OF ONTARIO

May 31, 2018


READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

KOTT



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



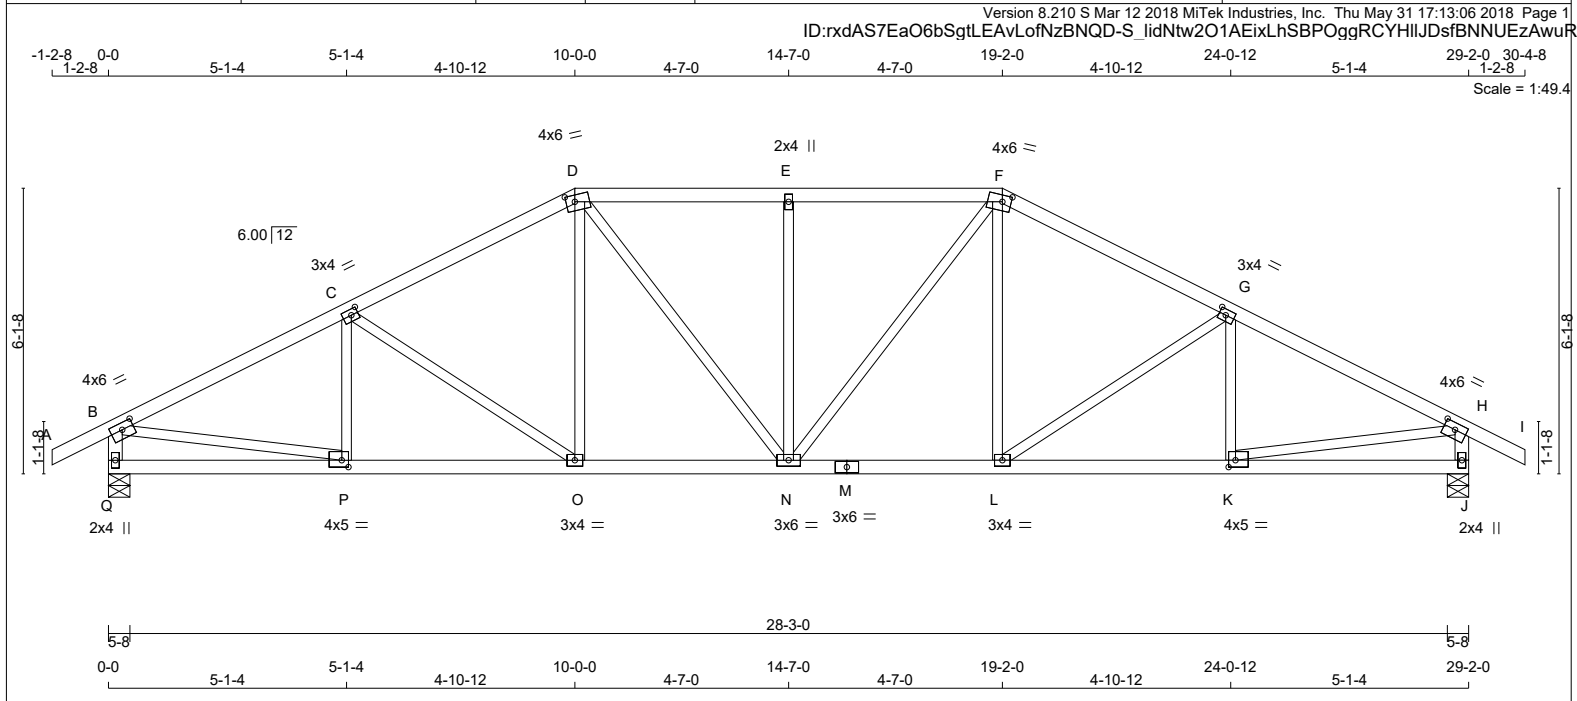

										TOTAL WEIGHT = 121 lb						
LUMBER N. L. G. A. RULES					DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										DESIGN CRITERIA	
CHORDS SIZE LUMBER DESCR.					BEARINGS											
A - D 2x4 DRY No.2 SPF					FACTORED GROSS REACTION					MAXIMUM FACTORED GROSS REACTION					INPUT BRG REQRD BRG	
D - F 2x4 DRY No.2 SPF					JT VERT HORZ					DOWN HORZ UPLIFT					IN-SX IN-SX	
F - I 2x4 DRY No.2 SPF					Q 1482 0					1482 0 0					5-8 5-8	
Q - B 2x4 DRY No.2 SPF					J 1482 0					1482 0 0					5-8 5-8	
J - H 2x4 DRY No.2 SPF																
Q - M 2x4 DRY No.2 SPF																
M - J 2x4 DRY No.2 SPF																
ALL WEBS 2x3 DRY No.2 SPF																
EXCEPT																
DRY: SEASONED LUMBER.					UNFACTORED REACTIONS											
					1ST LCASE					MAX./MIN. COMPONENT REACTIONS						
					JT COMBINED					SNOW LIVE PERM.LIVE WIND DEAD SOIL						
					Q 1038 739 / 0					0 / 0 0 / 0 0 / 0 299 / 0 0 / 0						
					J 1038 739 / 0					0 / 0 0 / 0 0 / 0 299 / 0 0 / 0						
															LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM	

PLATES (table is in inches)							BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, J							THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010			
JT	TYPE	PLATES	W	LEN	Y	X	BRACING							THIS DESIGN COMPLIES WITH:			
B	TMVW-t	MT20	4.0	6.0	1.75	3.00	TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.52 FT.							- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014			
C	TMWW-t	MT20	3.0	4.0	1.50	1.75	MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.							- CSA 086-09			
D	TTWW-m	MT20	4.0	6.0	1.75	2.25	ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.							- TPIC 2011			
E	TMW+w	MT20	2.0	4.0			LOADING							(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD			
F	TTWW-m	MT20	4.0	6.0	1.75	2.25	TOTAL LOAD CASES: (4)										
G	TMWW-t	MT20	3.0	4.0	1.50	1.75											
H	TMVW-t	MT20	4.0	6.0	1.75	3.00											
J	BMV1+p	MT20	2.0	4.0													
K	BMWW-t	MT20	4.0	5.0	1.75	1.75											
L	BMWW-t	MT20	3.0	4.0													
M	BS-t	MT20	3.0	6.0													
N	BMWWW-t	MT20	3.0	6.0													
O	BMWW-t	MT20	3.0	4.0													
P	BMWW-t	MT20	4.0	5.0	1.75	1.75											
Q	BMV1+p	MT20	2.0	4.0													
							C H O R D S							W E B S			
							MAX. FACTORED			FACTORED		MAX. FACTORED					
							MEMB. FORCE (LBS)			VERT. LOAD (PLF)		MEMB. FORCE (LBS)		MAX. FACTORED			
										LC1 MAX. UNBRAC							
										CSI (LC)							
															</		

CHORDS		WEBS	
MEMB.	FORCE (LBS)	MEMB.	FORCE (LBS)
A-B	0 / 22	P-C	-197 / 26
B-C	-1995 / 0	C-O	-288 / 0
C-D	-1769 / 0	O-D	0 / 249
D-E	-1765 / 0	D-N	0 / 319
E-F	-1765 / 0	N-E	-430 / 0
F-G	-1769 / 0	N-F	0 / 319
G-H	-1995 / 0	L-F	0 / 249
H-I	0 / 22	L-G	-288 / 0
Q-B	-1442 / 0	K-G	-197 / 26
J-H	-1442 / 0	B-P	0 / 1825
		K-H	0 / 1825

CHORDS		WEBS	
MEMB.	FORCE (LBS)	MEMB.	FORCE (LBS)
Q-P	0 / 0		
P-O	0 / 1802		
O-N	0 / 1567		
N-M	0 / 1567		
M-L	0 / 1567		
L-K	0 / 1802		
K-J	0 / 0		

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 23.3 PSF
 DL = 3.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.0 PSF
 TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
 - PART 9 OF OBC 2012, BCBC 2012, ABC 2014
 - CSA 086-09
 - TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
 CALCULATED VERT. DEFL.(LL) = L/ 999 (0.99")
 ALLOWABLE DEFL.(TL)= L/360 (0.97")
 CALCULATED VERT. DEFL.(TL) = L/ 999 (0.16")

CSI: TC=0.30/1.00 (G-H:1), BC=0.34/1.00 (K-L:1), WB=0.41/1.00 (H-K:1), SSI=0.17/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (H) (INPUT = 0.90)
 JSI METAL= 0.54 (K) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



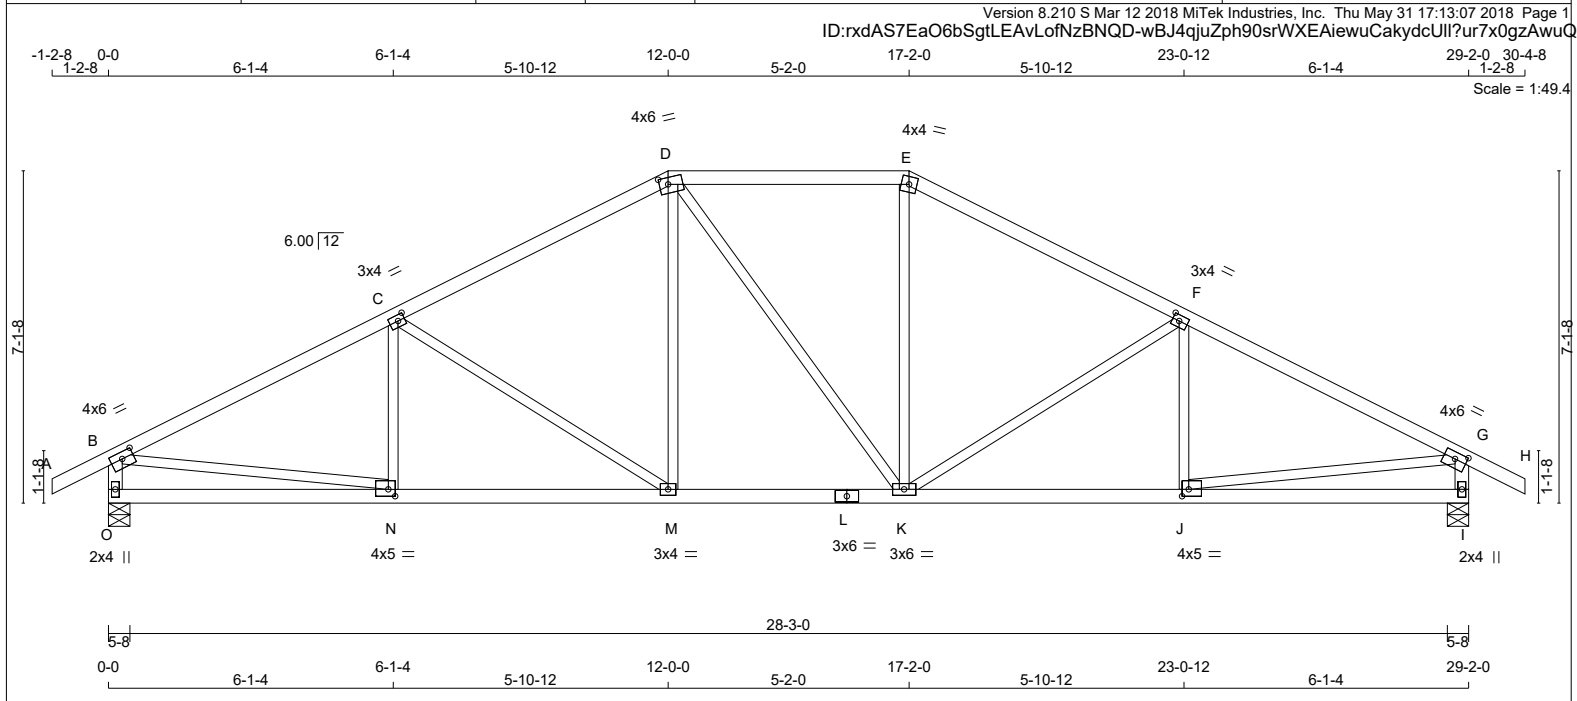


										TOTAL WEIGHT = 118 lb																																																																																																											
LUMBER N. L. G. A. RULES <table><thead><tr><th>CHORDS</th><th>SIZE</th><th></th><th>LUMBER</th><th>DESCR.</th></tr></thead><tbody><tr><td>A - D</td><td>2x4</td><td>DRY</td><td>No.2</td><td>SPF</td></tr><tr><td>D - E</td><td>2x4</td><td>DRY</td><td>No.2</td><td>SPF</td></tr><tr><td>E - H</td><td>2x4</td><td>DRY</td><td>No.2</td><td>SPF</td></tr><tr><td>O - B</td><td>2x4</td><td>DRY</td><td>No.2</td><td>SPF</td></tr><tr><td>I - G</td><td>2x4</td><td>DRY</td><td>No.2</td><td>SPF</td></tr><tr><td>O - L</td><td>2x4</td><td>DRY</td><td>No.2</td><td>SPF</td></tr><tr><td>L - I</td><td>2x4</td><td>DRY</td><td>No.2</td><td>SPF</td></tr></tbody></table> ALL WEBS 2x3 DRY No.2 SPF EXCEPT DRY: SEASONED LUMBER.										CHORDS	SIZE		LUMBER	DESCR.	A - D	2x4	DRY	No.2	SPF	D - E	2x4	DRY	No.2	SPF	E - H	2x4	DRY	No.2	SPF	O - B	2x4	DRY	No.2	SPF	I - G	2x4	DRY	No.2	SPF	O - L	2x4	DRY	No.2	SPF	L - I	2x4	DRY	No.2	SPF	DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS <table><thead><tr><th></th><th colspan="2">FACTORED GROSS REACTION</th><th colspan="2">MAXIMUM FACTORED GROSS REACTION</th><th>INPUT BRG</th><th>REQRD BRG</th></tr><tr><th>JT</th><th>VERT</th><th>HORZ</th><th>DOWN</th><th>HORZ</th><th>UPLIFT</th><th>IN-SX</th></tr></thead><tbody><tr><td>O</td><td>1482</td><td>0</td><td>1482</td><td>0</td><td>0</td><td>5-8</td></tr><tr><td>I</td><td>1482</td><td>0</td><td>1482</td><td>0</td><td>0</td><td>5-8</td></tr></tbody></table> UNFACTORED REACTIONS <table><thead><tr><th>JT</th><th>1ST LCASE COMBINED</th><th colspan="5">MAX./MIN. COMPONENT REACTIONS</th></tr><tr><th></th><th></th><th>SNOW</th><th>LIVE</th><th>PERM.LIVE</th><th>WIND</th><th>DEAD</th></tr></thead><tbody><tr><td>O</td><td>1038</td><td>739 / 0</td><td>0 / 0</td><td>0 / 0</td><td>0 / 0</td><td>299 / 0</td></tr><tr><td>I</td><td>1038</td><td>739 / 0</td><td>0 / 0</td><td>0 / 0</td><td>0 / 0</td><td>299 / 0</td></tr></tbody></table>											FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG	JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	O	1482	0	1482	0	0	5-8	I	1482	0	1482	0	0	5-8	JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS							SNOW	LIVE	PERM.LIVE	WIND	DEAD	O	1038	739 / 0	0 / 0	0 / 0	0 / 0	299 / 0	I	1038	739 / 0	0 / 0	0 / 0	0 / 0	299 / 0	DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 23.3 PSF DL = 3.0 PSF BOT CH. LL = 0.0 PSF DL = 7.0 PSF TOTAL LOAD = 33.3 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM	
CHORDS	SIZE		LUMBER	DESCR.																																																																																																																	
A - D	2x4	DRY	No.2	SPF																																																																																																																	
D - E	2x4	DRY	No.2	SPF																																																																																																																	
E - H	2x4	DRY	No.2	SPF																																																																																																																	
O - B	2x4	DRY	No.2	SPF																																																																																																																	
I - G	2x4	DRY	No.2	SPF																																																																																																																	
O - L	2x4	DRY	No.2	SPF																																																																																																																	
L - I	2x4	DRY	No.2	SPF																																																																																																																	
	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG																																																																																																															
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX																																																																																																															
O	1482	0	1482	0	0	5-8																																																																																																															
I	1482	0	1482	0	0	5-8																																																																																																															
JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS																																																																																																																			
		SNOW	LIVE	PERM.LIVE	WIND	DEAD																																																																																																															
O	1038	739 / 0	0 / 0	0 / 0	0 / 0	299 / 0																																																																																																															
I	1038	739 / 0	0 / 0	0 / 0	0 / 0	299 / 0																																																																																																															

							BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, I							THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010						
PLATES (table is in inches)							BRACING							THIS DESIGN COMPLIES WITH:						
JT TYPE PLATES W LEN Y X							TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.34 FT.							- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014						
B TMVW-t MT20 4.0 6.0 1.75 3.00							MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.							- CSA 086-09						
C TMWW-t MT20 3.0 4.0 1.50 1.75							ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.							- TPIC 2011						
D TTWW-m MT20 4.0 6.0 1.75 2.25																				
E TTW-m MT20 4.0 4.0							LOADING							(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD						
F TMWW-t MT20 3.0 4.0 1.50 1.75																				
G TMVW-t MT20 4.0 6.0 1.75 3.00							TOTAL LOAD CASES: (4)													
I BMV1+p MT20 2.0 4.0																				
J BMWW-t MT20 4.0 5.0 1.75 1.75							CHORDS							WEBS						
K BMWWW-t MT20 3.0 6.0																				
L BS-t MT20 3.0 6.0							MEMB. MAX. FACTORED FORCE (LBS)							MEMB. MAX. FACTORED FORCE (LBS)						
M BMWW-t MT20 3.0 4.0							VERT. LOAD (PLF)							MAX. UNBRAC LENGTH						
N BMWW-t MT20 4.0 5.0 1.75 1.75							FROM TO							FR-TO						
O BMV1+p MT20 2.0 4.0							FR-TO							FR-TO						
							A-B 0 / 22 -77.4 -77.4 0.09 (1) 10.00							N-C -128 / 64 0.03 (1)						
							B-C -2015 / 0 -77.4 -77.4 0.44 (1) 4.34							C-M -465 / 0 0.46 (1)						
							C-D -1628 / 0 -77.4 -77.4 0.40 (1) 4.77							M-D 0 / 346 0.08 (1)						
							D-E -1439 / 0 -77.4 -77.4 0.29 (1) 5.13							D-K 0 / 0 0.00 (1)						
							E-F -1628 / 0 -77.4 -77.4 0.40 (1) 4.77							K-E 0 / 347 0.08 (1)						
							F-G -2015 / 0 -77.4 -77.4 0.44 (1) 4.34							K-F -464 / 0 0.46 (1)						
							G-H 0 / 22 -77.4 -77.4 0.09 (1) 10.00							J-F -129 / 63 0.03 (1)						
							O-B -1437 / 0 0.0 0.0 0.14 (1) 6.81							B-N 0 / 1840 0.41 (1)						
							I-G -1436 / 0 0.0 0.0 0.14 (1) 6.81							J-G 0 / 1840 0.41 (1)						
							O-N 0 / 0 -17.5 -17.5 0.15 (4) 10.00													
							N-M 0 / 1824 -17.5 -17.5 0.36 (1) 10.00													
							M-L 0 / 1438 -17.5 -17.5 0.29 (1) 10.00													
							L-K 0 / 1438 -17.5 -17.5 0.29 (1) 10.00													
							K-J 0 / 1823 -17.5 -17.5 0.36 (1) 10.00													
							J-I 0 / 0 -17.5 -17.5 0.15 (4) 10.00													

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010						
THIS DESIGN COMPLIES WITH:						
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014						
- CSA 086-09						
- TPIC 2011						
(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD						
ALLOWABLE DEFL.(LL)= L/360 (0.97")						
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.09")						
ALLOWABLE DEFL.(TL)= L/360 (0.97")						
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.16")						
CSI: TC=0.44/1.00 (B-C:1) , BC=0.36/1.00 (M-N:1) ,						
WB=0.46/1.00 (C-M:1) , SSI=0.20/1.00 (F-G:1)						
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10						
COMP=1.10 SHEAR=1.10 TENS= 1.10						
COMPANION LIVE LOAD FACTOR = 0.50						
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .						
NAIL VALUES						
PLATE GRIP(DRY) SHEAR SECTION						

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

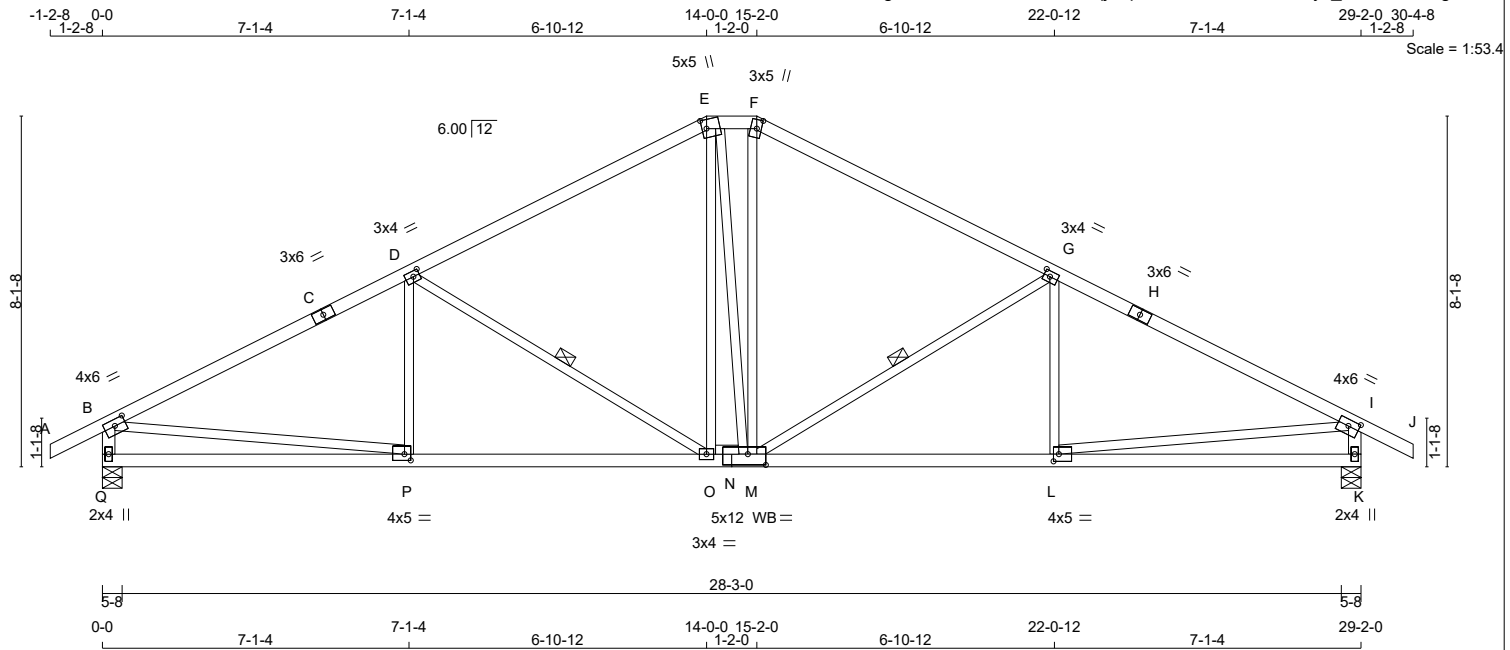

TOTAL WEIGHT = 125 lb

LUMBER				DESCR.
CHORDS	SIZE	LUMBER		
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - J	2x4	DRY	No.2	SPF
K - B	2x4	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF
Q - N	2x4	DRY	No.2	SPF
N - K	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	4.0	6.0	1.75 3.00
C	TS-t	MT20	3.0	6.0	
D	TMWW-t	MT20	3.0	4.0	1.50 1.75
E	TTWW+m	MT20	5.0	5.0	2.50 1.25
F	TTW+m	MT20	3.0	5.0	2.50 1.25
G	TMWW-t	MT20	3.0	4.0	1.50 1.75
H	TS-t	MT20	3.0	6.0	
I	TMVW-t	MT20	4.0	6.0	1.75 3.00
K	BMV1+p	MT20	2.0	4.0	
L	BMWW-t	MT20	4.0	5.0	2.00 1.50
M					
N	BSWWW-I	MT20	5.0	12.0	3.00 5.00
O	BMWW-t	MT20	3.0	4.0	
P	BMWW-t	MT20	4.0	5.0	1.75 1.75
Q	BMV1+p	MT20	2.0	4.0	

WB - INDICATES BLOCKING REQUIRED

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
Q	1482	0	1482	0	0
K	1482	0	1482	0	0

UNFACTORED REACTIONS		1ST LCASE	MAX./MIN. COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
Q	1038	739 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0
K	1038	739 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.11 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 - 1x4 LATERAL BRACE(S) AT 1/2 LENGTH OF D-O, G-M. DBS = 20-0-0. CBF = 79 LBS.

DBS = DIAGONAL BRACE SPACING (MAX). CBF = CUMULATIVE BRACING FORCE (PER BRACE). FASTEN LATERAL BRACE(S) USING (0.122"x3") SPIRAL NAILS : 1 NAIL FOR 2x3 BRACE(S), 2 FOR 1x4, 2x4, 2x5, 3 FOR 2x6, 4 FOR 2x8, 5 FOR 2x10, AND 6 FOR 2x12.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	FACTORED VERT. LOAD (PLF)
FR-TO		FROM TO	CSI (LC)	FR-TO		FROM TO	CSI (LC)
A-B	0 / 22	-77.4 -77.4	0.09 (1)	10.00	P-D	-70 / 98	0.03 (4)
B-C	-2011 / 0	-77.4 -77.4	0.62 (1)	4.11	D-O	-633 / 0	0.29 (1)
C-D	-2011 / 0	-77.4 -77.4	0.62 (1)	4.11	O-E	0 / 373	0.08 (1)
D-E	-1470 / 0	-77.4 -77.4	0.54 (1)	4.74	E-M	0 / 27	0.01 (1)
E-F	-1296 / 0	-77.4 -77.4	0.03 (1)	5.66	M-F	0 / 401	0.09 (1)
F-G	-1473 / 0	-77.4 -77.4	0.55 (1)	4.74	M-G	-627 / 0	0.29 (1)
G-H	-2009 / 0	-77.4 -77.4	0.62 (1)	4.11	L-G	-75 / 96	0.03 (4)
H-I	-2009 / 0	-77.4 -77.4	0.62 (1)	4.11	B-P	0 / 1836	0.41 (1)
I-J	0 / 22	-77.4 -77.4	0.09 (1)	10.00	L-I	0 / 1835	0.41 (1)
Q-B	-1431 / 0	0.0 0.0	0.14 (1)	6.82			
K-I	-1430 / 0	0.0 0.0	0.14 (1)	6.82			
Q-P	0 / 0	-17.5 -17.5	0.22 (4)	10.00			
P-O	0 / 1824	-17.5 -17.5	0.40 (1)	10.00			
O-N	0 / 1292	-17.5 -17.5	0.30 (1)	10.00			
N-M	0 / 1292	-17.5 -17.5	0.30 (1)	10.00			
M-L	0 / 1823	-17.5 -17.5	0.39 (1)	10.00			
L-K	0 / 0	-17.5 -17.5	0.21 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL)= L/999 (0.09")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL)= L/999 (0.19")

CSI: TC=0.62/1.00 (B-D:1), BC=0.40/1.00 (O-P:1), WB=0.41/1.00 (B-P:1), SSI=0.24/1.00 (B-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.90 (L) (INPUT = 0.90)
JSI METAL= 0.55 (P) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

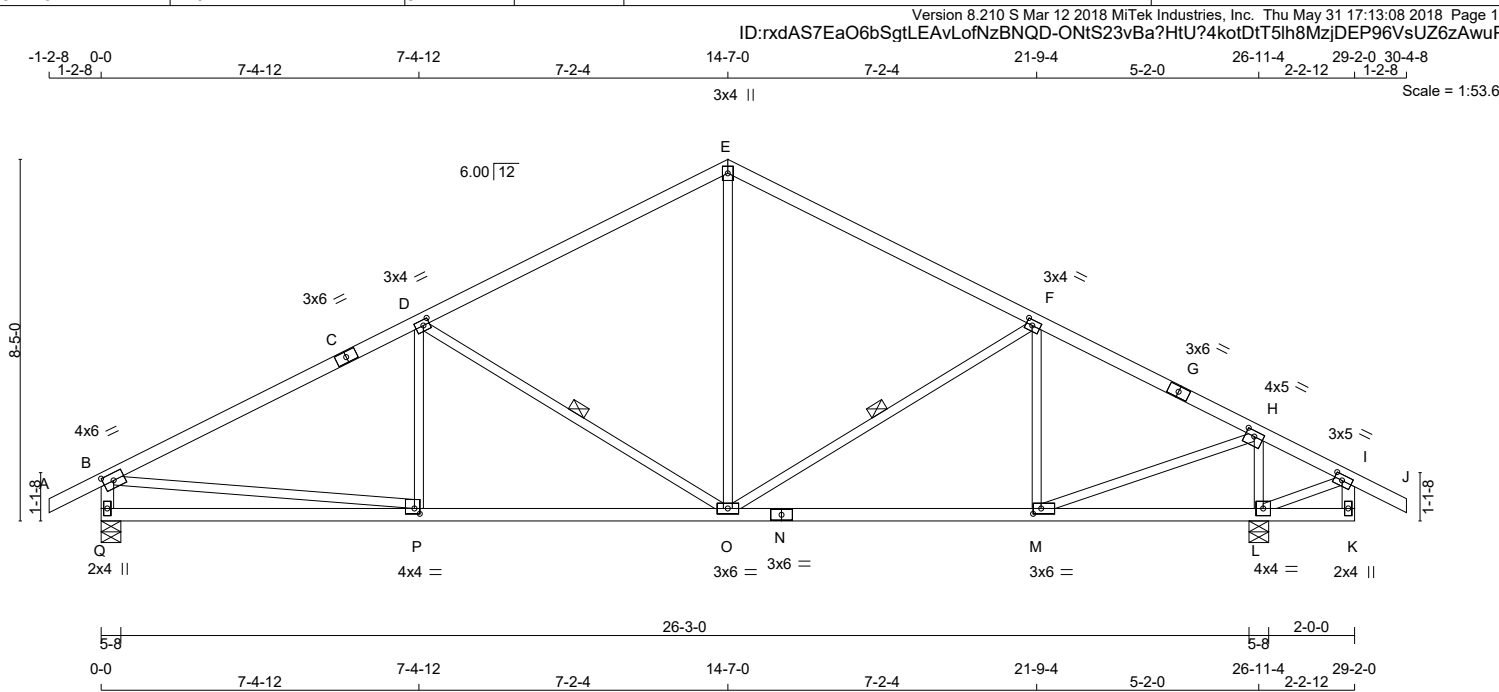

TOTAL WEIGHT = 8 X 115 = 919 lb

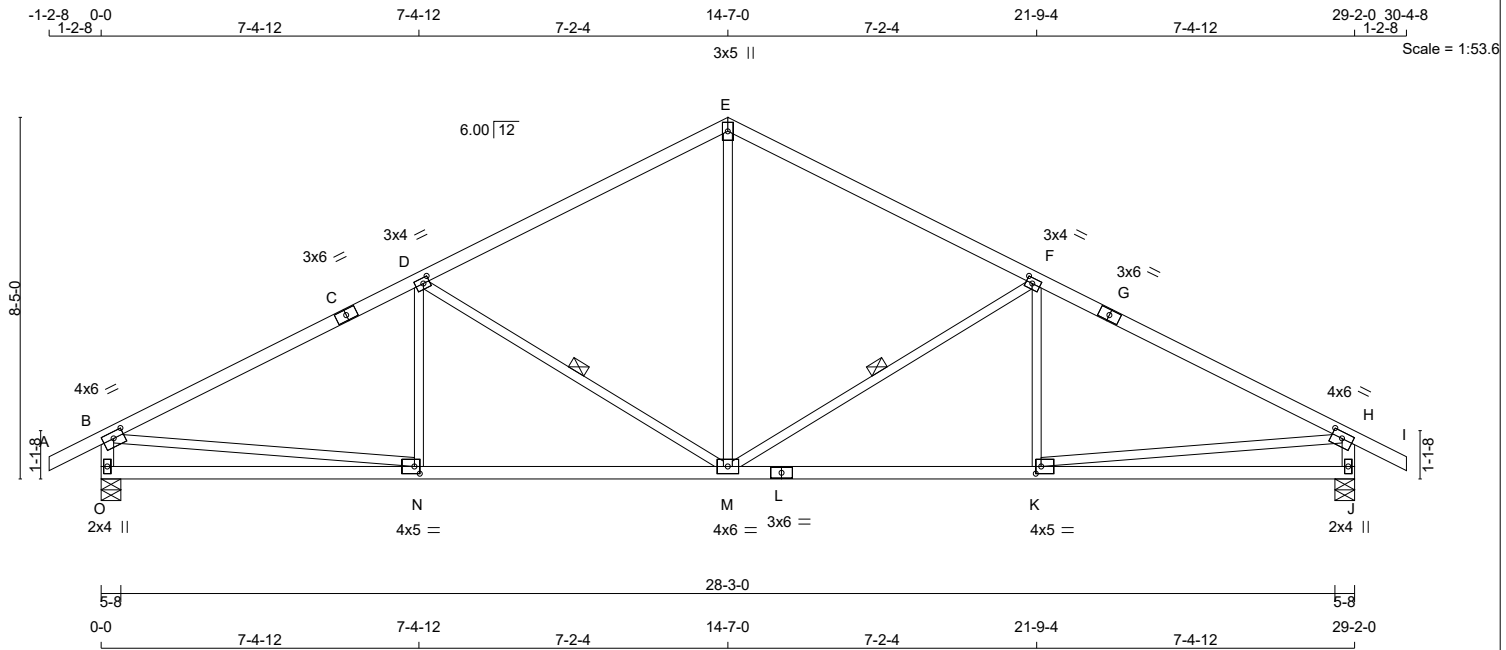

TOTAL WEIGHT = 5 X 113 = 567 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
O - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
O - L	2x4	DRY	No.2
L - J	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	4.0	6.0	1.75 3.00
C	TS-t	MT20	3.0	6.0	
D	TMWW-t	MT20	3.0	4.0	1.50 1.75
E	TTW+p	MT20	3.0	5.0	
F	TMWW-t	MT20	3.0	4.0	1.50 1.75
G	TS-t	MT20	3.0	6.0	
H	TMVW-t	MT20	4.0	6.0	1.75 3.00
J	BMV1+p	MT20	2.0	4.0	
K	BMWW-t	MT20	4.0	5.0	2.00 1.50
L	BS-t	MT20	3.0	6.0	
M	BMWW-t	MT20	4.0	6.0	
N	BMWW-t	MT20	4.0	5.0	2.00 1.50
O	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT		VERT	HORZ	DOWN	UP
O		1482	0	0	5-8
J		1482	0	0	5-8

UNFACTORED REACTIONS		1ST LCASE	MAX./MIN. COMPONENT REACTIONS				
JT		COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
O		1038	739 / 0	0 / 0	0 / 0	0 / 0	299 / 0
J		1038	739 / 0	0 / 0	0 / 0	0 / 0	299 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.03 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 - 1x4 LATERAL BRACE(S) AT 1/2 LENGTH OF F-M, D-M. DBS = 20-0-0. CBF = 84 LBS.

DBS = DIAGONAL BRACE SPACING (MAX). CBF = CUMULATIVE BRACING FORCE (PER BRACE). FASTEN LATERAL BRACE(S) USING (0.122"x3") SPIRAL NAILS : 1 NAIL FOR 2x3 BRACE(S), 2 FOR 1x4, 2x4, 2x5, 3 FOR 2x6, 4 FOR 2x8, 5 FOR 2x10, AND 6 FOR 2x12.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC1)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 22	-77.4	-77.4 0.09 (1)	10.00	M-E	0 / 835	0.19 (1)
B-C	-2004 / 0	-77.4	-77.4 0.68 (1)	4.03	M-F	-669 / 0	0.33 (1)
C-D	-2004 / 0	-77.4	-77.4 0.68 (1)	4.03	K-F	-61 / 103	0.04 (4)
D-E	-1431 / 0	-77.4	-77.4 0.59 (1)	4.70	D-M	-669 / 0	0.33 (1)
E-F	-1431 / 0	-77.4	-77.4 0.59 (1)	4.70	N-D	-61 / 103	0.04 (4)
F-G	-2004 / 0	-77.4	-77.4 0.68 (1)	4.03	B-N	0 / 1830	0.41 (1)
G-H	-2004 / 0	-77.4	-77.4 0.68 (1)	4.03	K-H	0 / 1830	0.41 (1)
H-I	0 / 22	-77.4	-77.4 0.09 (1)	10.00			
O-B	-1428 / 0	0.0	0.0 0.14 (1)	6.83			
J-H	-1428 / 0	0.0	0.0 0.14 (1)	6.83			
O-N	0 / 0	-17.5	-17.5 0.22 (4)	10.00			
N-M	0 / 1819	-17.5	-17.5 0.40 (1)	10.00			
M-L	0 / 1819	-17.5	-17.5 0.40 (1)	10.00			
L-K	0 / 1819	-17.5	-17.5 0.40 (1)	10.00			
K-J	0 / 0	-17.5	-17.5 0.22 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.18")

CSI: TC=0.68/1.00 (F-H:1), BC=0.40/1.00 (K-M:1), WB=0.41/1.00 (H-K:1), SSI=0.25/1.00 (F-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (N) (INPUT = 0.90)
JSI METAL= 0.55 (K) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



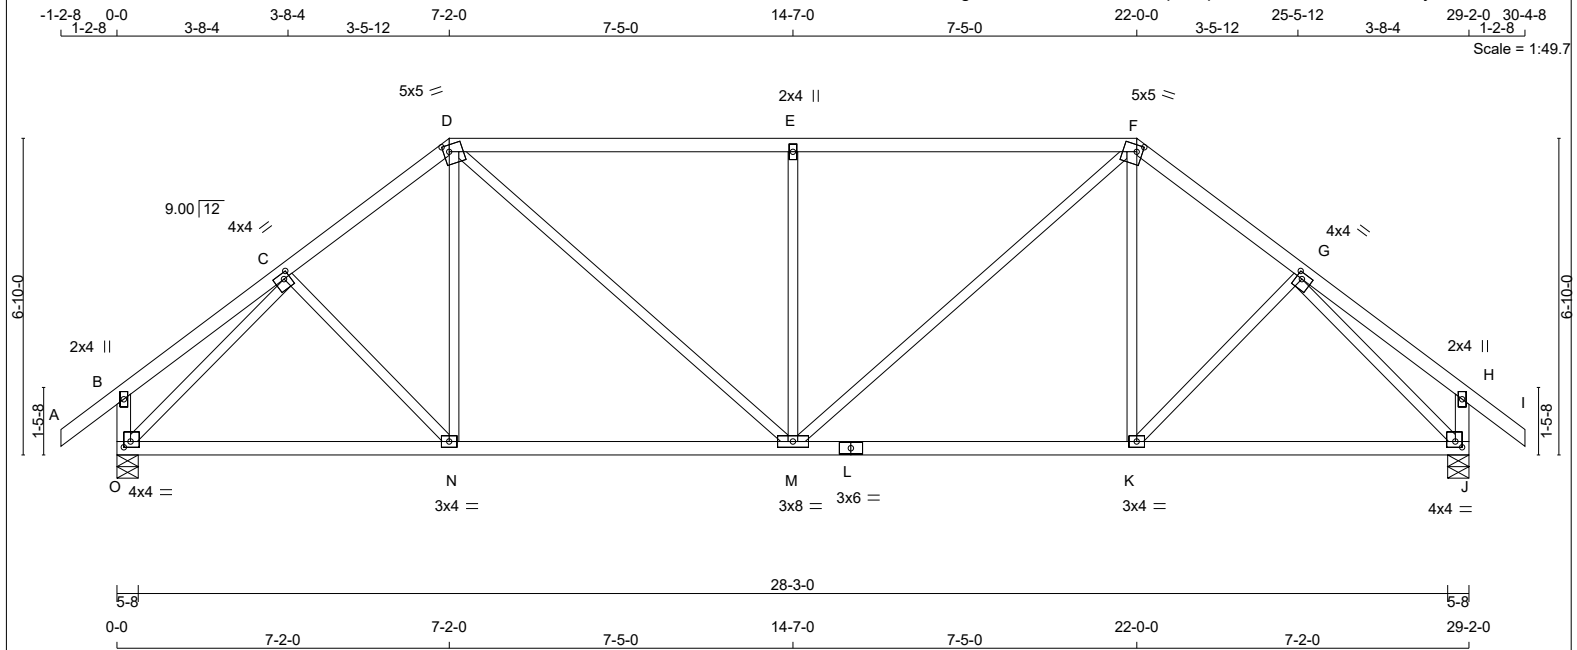

TOTAL WEIGHT = 124 lb

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
O - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
O - L	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
C	TMWW-t	MT20	4.0	4.0	1.50	1.50
D	TTWW-m	MT20	5.0	5.0	1.75	1.50
E	TMW+w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	5.0	1.75	1.50
G	TMWW-t	MT20	4.0	4.0	1.50	1.50
H	TMV+p	MT20	2.0	4.0		
J	BMVW1-t	MT20	4.0	4.0	1.50	1.75
K	BMWW-t	MT20	3.0	4.0		
L	BS-t	MT20	3.0	6.0		
M	BMWWW-t	MT20	3.0	8.0		
N	BMWW-t	MT20	3.0	4.0		
O	BMVW1-t	MT20	4.0	4.0	1.50	1.75

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
O	1484	0	1484	0	5-8	5-8
J	1484	0	1484	0	5-8	5-8

UNFACTORED REACTIONS

JT	MAX./MIN. COMPONENT REACTIONS						
	1ST LCASE COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
O	1039	740 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0
J	1039	740 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.82 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)		
FR-TO		FROM TO			FR-TO				
A-B	0 / 30	-77.4	-77.4	0.09 (1)	10.00	C-N	0 / 52	0.02 (4)	
B-C	0 / 18	-77.4	-77.4	0.15 (1)	10.00	N-D	0 / 133	0.04 (4)	
C-D	-1471 / 0	-77.4	-77.4	0.18 (1)	5.22	D-M	0 / 624	0.14 (1)	
D-E	-1630 / 0	-77.4	-77.4	0.92 (1)	3.82	M-E	-706 / 0	0.55 (1)	
E-F	-1630 / 0	-77.4	-77.4	0.92 (1)	3.82	M-F	0 / 624	0.14 (1)	
F-G	-1471 / 0	-77.4	-77.4	0.18 (1)	5.22	K-F	0 / 133	0.04 (4)	
G-H	0 / 18	-77.4	-77.4	0.15 (1)	10.00	K-G	0 / 52	0.02 (4)	
H-I	0 / 30	-77.4	-77.4	0.09 (1)	10.00	O-C	-1678 / 0	0.73 (1)	
O-B	-209 / 0	0.0	0.0	0.02 (1)	7.81	G-J	-1678 / 0	0.73 (1)	
J-H	-209 / 0	0.0	0.0	0.02 (1)	7.81				
O-N	0 / 1147	-17.5	-17.5	0.31 (1)	10.00				
N-M	0 / 1162	-17.5	-17.5	0.32 (4)	10.00				
M-L	0 / 1162	-17.5	-17.5	0.32 (4)	10.00				
L-K	0 / 1162	-17.5	-17.5	0.32 (4)	10.00				
K-J	0 / 1147	-17.5	-17.5	0.31 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.07")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.13")

CSI: TC=0.92/1.00 (D-E:1), BC=0.32/1.00 (K-M:4), WB=0.73/1.00 (G-J:1), SSI=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (J) (INPUT = 0.90)
JSI METAL= 0.62 (C) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



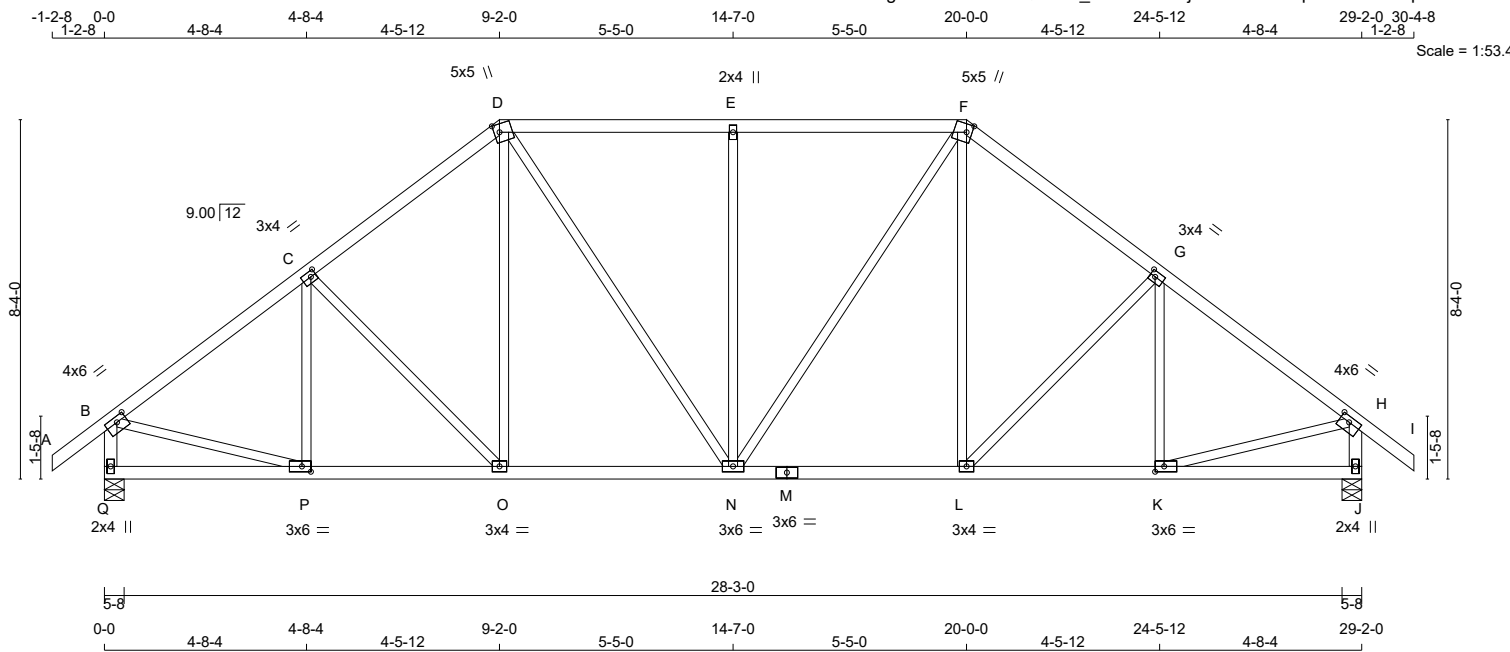

TOTAL WEIGHT = 137 lb
[M][F]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
Q - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
Q - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	4.0	6.0	1.50 2.75
C	TMWW-t	MT20	3.0	4.0	1.50 1.50
D	TTWW+m	MT20	5.0	5.0	2.25 1.50
E	TMW+w	MT20	2.0	4.0	
F	TTWW+m	MT20	5.0	5.0	2.25 1.50
G	TMWW-t	MT20	3.0	4.0	1.50 1.50
H	TMVW-t	MT20	4.0	6.0	1.50 2.75
J	BMV1+p	MT20	2.0	4.0	
K	BMWW-t	MT20	3.0	6.0	1.50 2.50
L	BMWW-t	MT20	3.0	4.0	
M	BS-t	MT20	3.0	6.0	
N	BMWWW-t	MT20	3.0	6.0	
O	BMWW-t	MT20	3.0	4.0	
P	BMWW-t	MT20	3.0	6.0	1.50 2.50
Q	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
Q	1484	0	1484	0	0
J	1484	0	1484	0	0

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
Q	1039	740 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0
J	1039	740 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.13 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 30	-77.4 -77.4	0.09 (1)	10.00	P-C	-209 / 13	0.08 (1)
B-C	-1498 / 0	-77.4 -77.4	0.24 (1)	5.13	C-O	-188 / 0	0.15 (1)
C-D	-1386 / 0	-77.4 -77.4	0.23 (1)	5.29	O-D	0 / 222	0.05 (1)
D-E	-1293 / 0	-77.4 -77.4	0.31 (1)	5.32	D-N	0 / 365	0.08 (1)
E-F	-1293 / 0	-77.4 -77.4	0.31 (1)	5.32	N-E	-511 / 0	0.70 (1)
F-G	-1386 / 0	-77.4 -77.4	0.23 (1)	5.29	N-F	0 / 365	0.08 (1)
G-H	-1498 / 0	-77.4 -77.4	0.24 (1)	5.13	L-F	0 / 222	0.05 (1)
H-I	0 / 30	-77.4 -77.4	0.09 (1)	10.00	L-G	-188 / 0	0.15 (1)
Q-B	-1448 / 0	0.0 0.0	0.15 (1)	6.79	K-G	-209 / 13	0.08 (1)
J-H	-1448 / 0	0.0 0.0	0.15 (1)	6.79	B-P	0 / 1253	0.28 (1)
					K-H	0 / 1253	0.28 (1)
Q-P	0 / 0	-17.5 -17.5	0.08 (4)	10.00			
P-O	0 / 1218	-17.5 -17.5	0.24 (1)	10.00			
O-N	0 / 1089	-17.5 -17.5	0.23 (1)	10.00			
N-M	0 / 1089	-17.5 -17.5	0.23 (1)	10.00			
M-L	0 / 1089	-17.5 -17.5	0.23 (1)	10.00			
L-K	0 / 1218	-17.5 -17.5	0.24 (1)	10.00			
K-J	0 / 0	-17.5 -17.5	0.08 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.0	PSF
TOTAL LOAD		=	33.3	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL)= L/999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL)= L/999 (0.10")

CSI: TC=0.31/1.00 (D-E:1), BC=0.24/1.00 (O-P:1), WB=0.70/1.00 (E-N:1), SSI=0.20/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.86 (N) (INPUT = 0.90)
JSI METAL= 0.42 (B) (INPUT = 1.00)




READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



B2 S-P-F #2 2.000" X 8.000" 2-Ply - PASSED

Level: Level

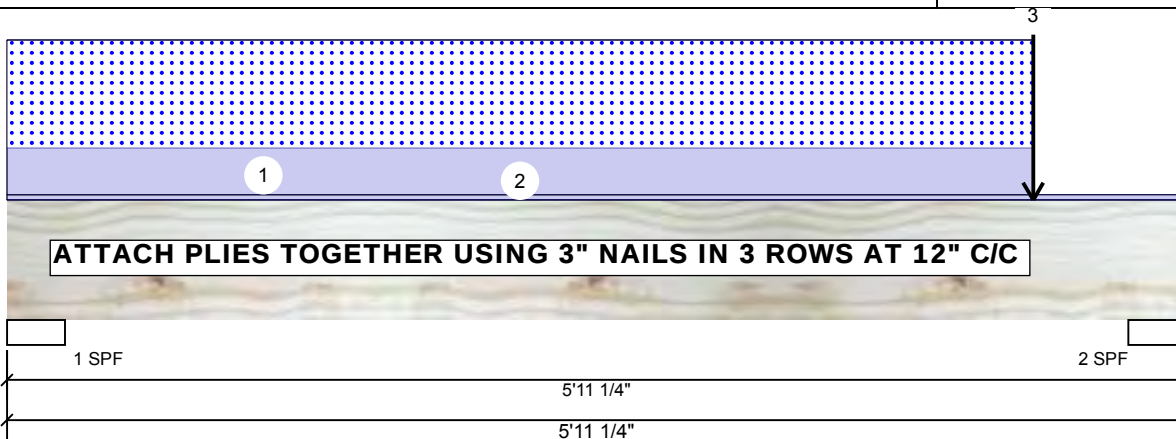

Member Information

Type:	Girder	Application:	Roof (Residential)
Plies:	2	Slope:	0/12
Moisture Condition:	Dry	Design Method:	LSD
Deflection LL:	480	Building Code:	NBCC 2010 / OBC 2012
Deflection TL:	240	Load Sharing:	No
Importance:	Normal	Deck:	Not Checked
		Vibration:	Not Checked

Unfactored Reactions UNPATTERNED lb (Uplift)

Brg	Live	Dead	Snow	Wind
1	0	331	699	0
2	0	611	1352	0

Bearings and Factored Reactions

Bearing	Length	Cap.	React D/L lb	Total	Ld. Case	Ld. Comb.
1 - SPF	3.500"	23%	414 / 1048	1462	L	1.25D+1.5S
2 - SPF	3.500"	43%	764 / 2028	2792	L	1.25D+1.5S

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	2169 ft-lb	3'4 15/16"	4047 ft-lb	0.536 (54%)	1.25D+1.5S	L
Unbraced	2169 ft-lb	3'4 15/16"	4024 ft-lb	0.539 (54%)	1.25D+1.5S	L
Shear	2546 lb	5'1 1/4"	3406 lb	0.747 (75%)	1.25D+1.5S	L
LL Defl inch	0.044 (L/1493)	3' 15/16"	0.137 (L/480)	0.320 (32%)	S	L
TL Defl inch	0.065 (L/1019)	3' 15/16"	0.274 (L/240)	0.240 (24%)	D+S	L

Design Notes

- Girders are designed to be supported on the bottom edge only.
- Multiple plies must be fastened together as per manufacturer's details.
- Top loads must be supported equally by all plies.
- Top braced at bearings.
- Bottom braced at bearings.
- Lateral slenderness ratio based on full section width.



ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Part. Uniform	0-0-0 to 5-2-0		Top	88 PLF	0 PLF	204 PLF	0 PLF	
2	Uniform			Top	10 PLF	0 PLF	0 PLF	0 PLF	
3	Point	5-2-0		Top	428 lb	0 lb	997 lb	0 lb	

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.


Manufacturer Info



Kott Group
14 Anderson Blvd., On
L4A7X4
905-642-4400

B1 S-P-F #2 2.000" X 8.000" 2-Ply - PASSED

Level: Level

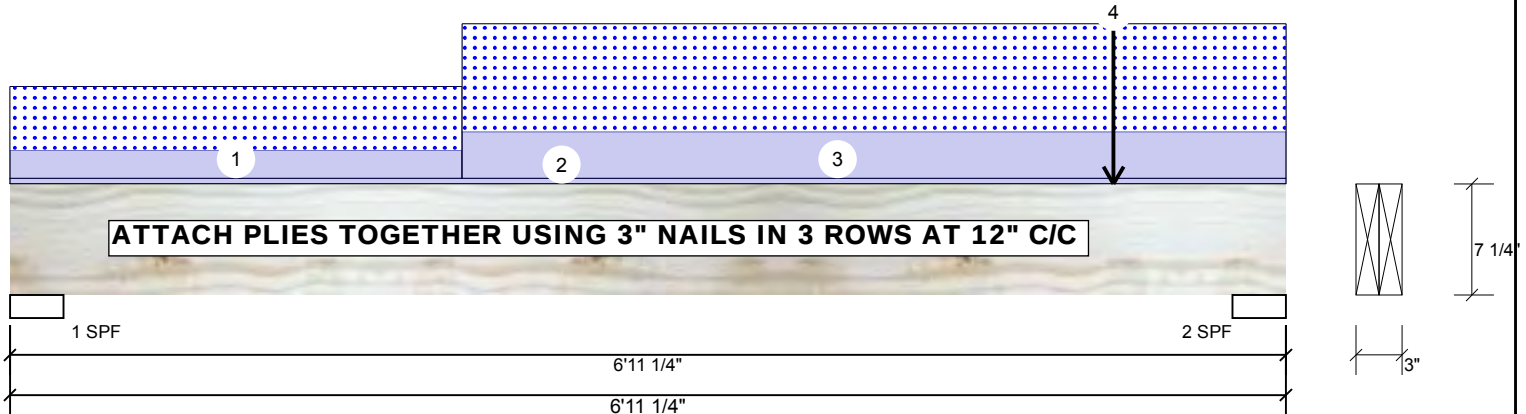

Member Information

Type:	Girder	Application:	Roof (Residential)
Plyes:	2	Slope:	0/12
Moisture Condition:	Dry	Design Method:	LSD
Deflection LL:	480	Building Code:	NBCC 2010 / OBC 2012
Deflection TL:	240	Load Sharing:	No
Importance:	Normal	Deck:	Not Checked
		Vibration:	Not Checked

Unfactored Reactions UNPATTERNED lb (Uplift)

Brg	Live	Dead	Snow	Wind
1	0	280	578	0
2	0	481	1093	0

Bearings and Factored Reactions

Bearing	Length	Cap. React D/L lb	Total Ld. Case	Ld. Comb.
1 - SPF	3.500"	19% 350 / 868	1218 L	1.25D+1.5S
2 - SPF	3.500"	35% 601 / 1639	2240 L	1.25D+1.5S

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	2369 ft-lb	3'10 7/16"	4047 ft-lb	0.585 (59%)	1.25D+1.5S	L
Unbraced	2369 ft-lb	3'10 7/16"	4015 ft-lb	0.590 (59%)	1.25D+1.5S	L
Shear	1890 lb	6'1 1/4"	3406 lb	0.555 (55%)	1.25D+1.5S	L
LL Defl inch	0.066 (L/1182)	3'7"	0.162 (L/480)	0.410 (41%)	S	L
TL Defl inch	0.096 (L/807)	3'6 15/16"	0.324 (L/240)	0.300 (30%)	D+S	L

Design Notes

- Girders are designed to be supported on the bottom edge only.
- Multiple plies must be fastened together as per manufacturer's details.
- Top loads must be supported equally by all plies.
- Top braced at bearings.
- Bottom braced at bearings.
- Lateral slenderness ratio based on full section width.



ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Part. Uniform	0-0-0 to 2-5-8		Top	51 PLF	0 PLF	119 PLF	0 PLF	
2	Uniform			Top	10 PLF	0 PLF	0 PLF	0 PLF	
3	Part. Uniform	2-5-8 to 6-11-4		Top	86 PLF	0 PLF	200 PLF	0 PLF	
4	Point	6-0-0		Top	181 lb	0 lb	483 lb	0 lb	

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

Manufacturer Info



Kott Group
14 Anderson Blvd., On
L4A7X4
905-642-4400



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B37579H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-09, section 10.9.4.1.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to **wind** the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-09, section 10.9.4
10. This design is not valid after April 30, 2019.

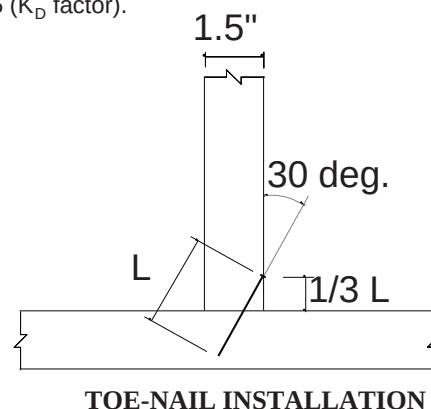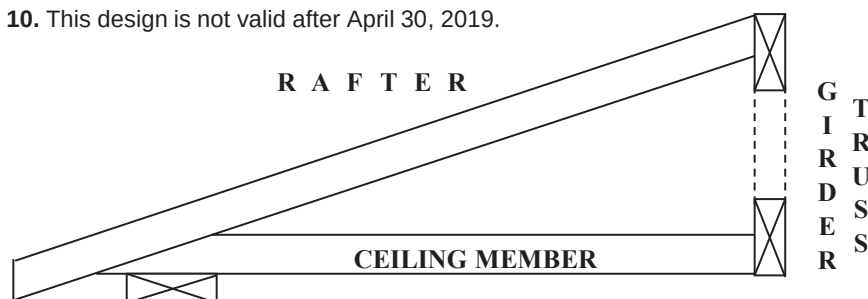

Nail type	Common wire	Common spiral	Common wire
Nail dia. (in)	0.160	0.152	0.144
	(3.5" nail)		(3" and 3.25" nail)
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS		
2X4 SPF	2	2	3
2X4 D. Fir	2	2	2
2X6 SPF	4	4	4
2X6 D. Fir	3	3	3



MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

PEO
Certificate No. 10889485



April 26, 2017

BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B37579H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind or earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-09, section 10.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-09, section 10.9.5
9. This design is not valid after April 30, 2019

Toe-nailing on 2x6 Bearing Plate

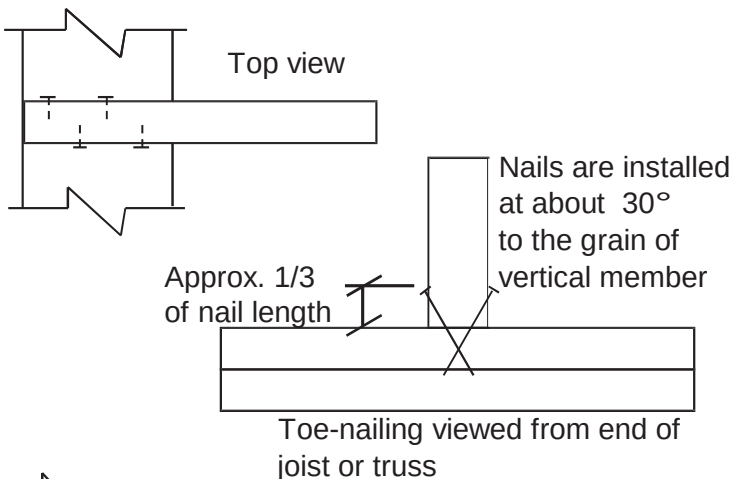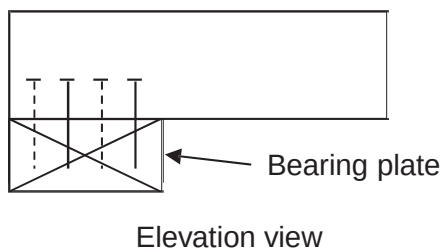

Toe-nailing on 2x4 Bearing Plate

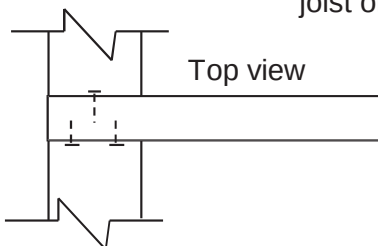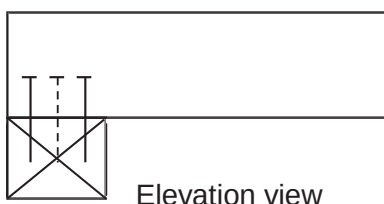

MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

PEO
Certificate No. 10889485



April 26, 2017