

ENGINEERING NOTE PAGE (ENP-1)
PLEASE READ PRIOR TO INSTALLATION

NE0618-034
GREEN YORK HOMES - GRANELLI HOME CORP -
INDIGO 1 ELEV 1

RESPONSIBILITIES

THIS DESIGN IS FOR AN INDIVIDUAL BUILDING COMPONENT AND HAS BEEN BASED ON INFORMATION PROVIDED BY THE DESIGN OFFICE OF KOTT LUMBER. THE UNDERSIGNED ENGINEER DISCLAIMS ANY RESPONSIBILITY FOR DAMAGES AS A RESULT OF FAULTY OR INCORRECT INFORMATION, SPECIFICATION AND/OR DESIGNS FURNISHED TO THE ENGINEER. THE UNDERSIGNED ENGINEER IS ONLY RESPONSIBLE FOR THE STRUCTURAL INTEGRITY OF THIS BUILDING COMPONENT FOR THE CONDITIONS AND LOADS SHOWN ON THIS DRAWING. THE STRUCTURAL INTEGRITY OF THE BUILDING AND THE VERIFICATION OF THE DIMENSIONS AND THE DESIGN LOADS USED ARE THE RESPONSIBILITY OF THE BUILDING DESIGNER.

TRUSSES ARE DESIGNED IN CONFORMANCE WITH THE RELEVANT SECTIONS OF THE NATIONAL BUILDING CODE OF CANADA OR THE CANADIAN CODE FOR FARM BUILDINGS, WHICHEVER APPLIES TO THE BUILDING TYPE INDICATED ON THE DRAWING

IT IS THE RESPONSIBILITY OF KOTT LUMBER TO ENSURE THAT TRUSSES ARE MANUFACTURED IN CONFORMANCE WITH THESE DESIGNS AND WITH THE SPECIFICATIONS OUTLINED BELOW. THE UNDERSIGNED ENGINEER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

USE AND OCCUPANCY

- The building is of the type indicated on the drawing

LOADING

- The truss loading intensity and distribution as well as load transfer mechanism is that indicated on the drawing
- No buildings, trees, parapets or other projections higher than the roof for which the trusses are used are located within a distance less than ten (10) times the difference in height, or five metres (16 ft) whichever is greater, unless the drawing indicates that the snow drifting has been taken into account

HANDLING, INSTALLATION AND BRACING

- The trusses must be handled and installed by a qualified professional as per the supplied document titled *Information for Truss Installers* and the BCSI-B1 and BCSI-B3 Summary Sheets
- The compression chords are laterally braced by continuous rigid diaphragm sheathing or as specified on the drawing
- Temporary and permanent bracing must be installed as indicated on the truss drawing and according to the BCSI-B1 and BCSI-B3 Summary Sheets. Bracing for the lateral stability of the truss is to be provided by the building designer
- **It is recommended that a Professional Engineer's advice be obtained for the bracing of trusses spanning more than 12.37m (40'-7")**

SUPPORTS

- The trusses are to be supported at the bearing points indicated and anchored to the supports where considered necessary by the designer of the overall structure
- Bearing sizes shown are the minimum required to prevent crushing of the truss members and do not necessarily take into account stability of the overall building structure
- Elevation of bearings must be carefully checked and shimmed to alignment for solid bearings
- Adequate wood truss bearing is the responsibility of the building designer.

DIMENSIONS


- Geometry of the truss and dimensions indicated on the drawing are identical to those of the installed truss.

Layout based on plans provided by
Jardin Design Group Inc.
Revision #2 dated May 22, 2018



PORCH BEAMS ASSUMED TO BE
2x2x10, NO BEAM SCHEDULE
PROVIDED ON PLANS
UNDERSIDE OF BEAMS TO BE 6"
BELOW COVERED PORCH FASCIA

THIS CERTIFICATION IS FOR THE ENGINEERING REVIEW OF
STRUCTURAL COMPONENTS SHOWN ON THIS DRAWING
AND IS LIMITED TO THE COMPONENTS SUPPLIED BY KOTT
LUMBER FOR THE LOADS AND CONDITIONS SHOWN ON
THE CALCULATION PAGE OF EACH COMPONENT. THE
PLACEMENT OF THESE COMPONENTS ON THIS LAYOUT IS
SHOWN FOR REFERENCE ONLY. ROOF TRUSSES MUST BE
INSTALLED ACCORDING TO MANUFACTURER'S GUIDELINES
AT 24" C/C UNLESS NOTED OTHERWISE. CONVENTIONAL
FRAMING SHOWN ON THE LAYOUT MUST BE DESIGNED
AND APPROVED BY THE PROJECT ENGINEER. TEMPORARY
AND PERMANENT BRACINGS OF THE ROOF AND BUILDING
ARE THE RESPONSIBILITY OF THE PROJECT ENGINEER
AND TO CONFORM TO BCSI GUIDELINES.

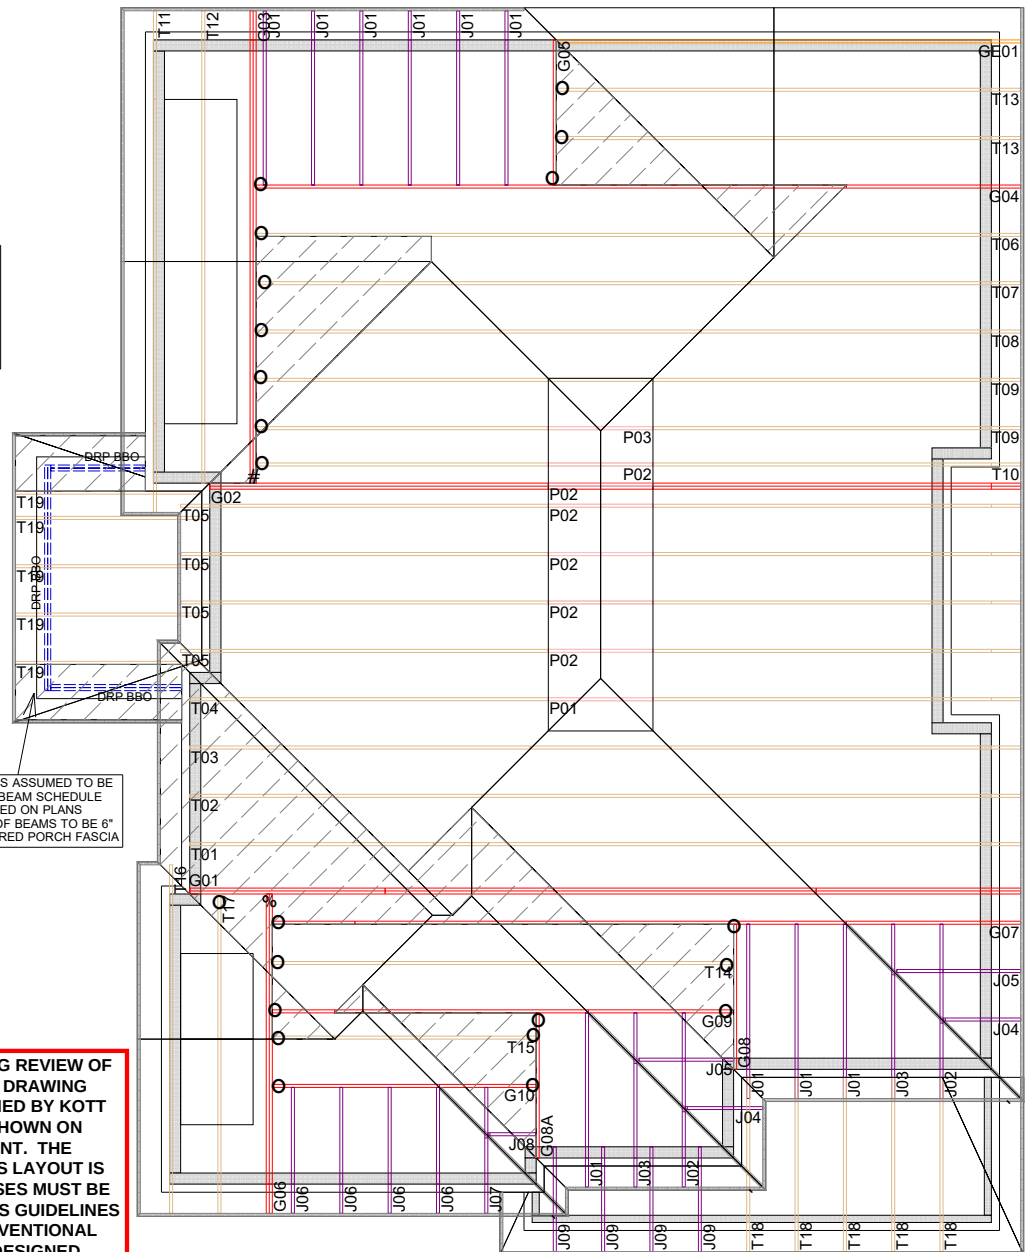

GARAGE TOP OF PLATE
TO MATCH UNDERSIDE
OF SOFFIT

ROOF TRUSS LAYOUT



CONVENTIONAL
FRAMING BY OTHERS

HANGER LEGEND

X - LUS24
- HGUS28-2

O - LJS26DS
% - HGUS26-2

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 23.3 psf
DL = 3.0 psf
BOT CH. LL = 0.0 psf
DL = 7.0 psf
TOTAL LOAD = 33.3 psf

SPACING @ 24" CENTERS,
THIS TRUSS SYSTEM IS DESIGN FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBC 2010

THIS DESIGN COMPLIES WITH PART 9 OF OBC 2012,
BCBC 2012, ABC 2012, CSA 086-09, TPIC 2011

ALLOWABLE DEFLECTION OF EACH COMPONENT = L/360

Model:	INDIGO 1 ELE 1
Customer:	GREEN YORK HOMES
Project:	GRANELLI HOME
Location:	BRAMPTON, ON
Drawn By:	DM
Date:	5/31/2018

SIZE AND LOCATION OF CONVENTIONAL FRAMING IS APPROXIMATE. ALL AREAS
MAY NOT BE SHOWN. REFER TO ARCHITECTURAL PLANS FOR DETAILS.

ALL CONVENTIONAL FRAMING TO CONFORM WITH PART 9 OF THE O.B.C RAFTER THAT
CROSS MEET OVER TRUSSES TO BE 2X4 SPF @ 24" O/C WITH 2X4 VERT POST TO THE
TRUSS BELOW EA CROSS PT. VERT POS. THAN 6' TO HAVE A LATERAL BRACING SO THAT
THE DISTANCE BETEN PT & VERT ROWS OF BRACING DOES NOT EXCEED 6'



LICENSED PROFESSIONAL ENGINEER
 N.A. EL-MASRI
 PROVINCE OF ONTARIO
 Jun 05, 2018

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
U	3-3-8	-4771	-4771	---	FRONT	VERT	TOTAL

CONTINUED ON PAGE 2

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMBMW1-m	MT20	8.0	8.0	4.25	Edge
B	TMWW-t	MT20	4.0	6.0	1.50	1.50
C	TTWW+m	MT20	5.0	6.0	2.25	1.75
D	TMW+w	MT20	2.0	4.0		
E	TMWWW-t	MT20	3.0	6.0		
F	TS-t	MT20	3.0	6.0		
G	TMW+w	MT20	2.0	4.0		
H	TTWW+m	MT20	5.0	5.0	1.75	1.50
I	TMWW-t	MT20	3.0	4.0	1.50	1.50
J	TMVW-t	MT20	4.0	5.0	1.75	2.00
L	BMV1+p	MT20	2.0	4.0		
M	BMWW-t	MT20	4.0	4.0	2.00	1.50
N	BMWW+t	MT20	3.0	4.0		
O	BS-t	MT20	4.0	6.0		
P	BMWWW-t	MT20	4.0	6.0	2.00	1.50
Q	BMW+w	MT20	2.0	4.0		
R	BS-t	MT20	4.0	6.0		
S	BMWWW-t	MT20	4.0	6.0		
T	BMWW-t	MT20	4.0	6.0	1.75	3.00
U	BMWW+t	MT20	3.0	10.0	4.50	1.50

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES

1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 4771.0 lbs FACTORED DOWN AT 3-3-8 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (I) (INPUT = 0.90)

JSI METAL= 0.63 (A) (INPUT = 1.00)



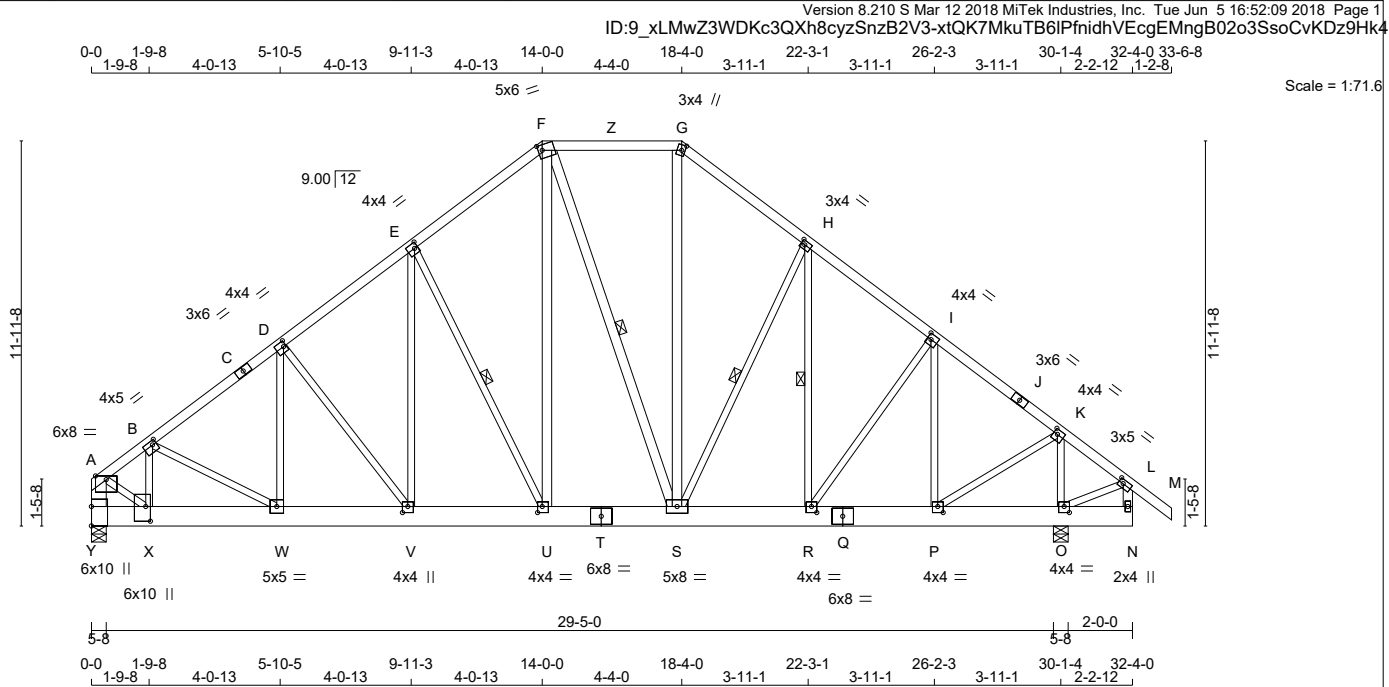

TOTAL WEIGHT = 2 X 224 = 448 lb [M]

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2 SPF
C - F	2x4	DRY	No.2 SPF
F - G	2x4	DRY	No.2 SPF
G - J	2x4	DRY	No.2 SPF
J - M	2x4	DRY	No.2 SPF
Y - A	2x6	DRY	No.2 SPF
N - L	2x4	DRY	No.2 SPF
Y - T	2x8	DRY	No.2 SPF
T - Q	2x8	DRY	No.2 SPF
Q - N	2x8	DRY	No.2 SPF
ALL WEBS EXCEPT	2x3	DRY	No.2 SPF
U - F	2x4	DRY	No.2 SPF
F - S	2x4	DRY	No.2 SPF
S - G	2x4	DRY	No.2 SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF **2** TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	TOP
C - F	12	TOP
F - G	12	TOP
G - J	12	TOP
J - M	12	TOP
N - L	12	TOP
Y - A	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
Y - T	12	SIDE(0.0)
T - Q	12	TOP
Q - N	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	
2x4	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	GROSS REACTION	VERT	HORZ	DOWN	HORZ	UPLIFT	BRG	IN-SX	BRG
Y	8153	0	8153	0	0	5-8	5-8	5-8	5-8
O	2210	0	2210	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX./MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
Y	5730	3964 / 0	0 / 0	0 / 0	0 / 0	1767 / 0	0 / 0
O	1552	1081 / 0	0 / 0	0 / 0	0 / 0	472 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Y, O

BRACING

FOR SECTION F-G, MAX. PURLIN SPACING = 2.00 FT.
FOR OTHER SECTIONS, TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 - 1x4 LATERAL BRACE(S) AT 1/2 LENGTH OF E-U, F-S, H-S, H-R. DBS = 20-0-0. CBF = 177 LBS.

DBS = DIAGONAL BRACE SPACING (MAX). CBF = CUMULATIVE BRACING FORCE (PER BRACE). FASTEN LATERAL BRACE(S) TO EACH PLY USING (0.122"x3") SPIRAL NAILS : 1 NAIL FOR 2x3 BRACE(S), 2 FOR 1x4, 2x4, 2x5, 3 FOR 2x6, 4 FOR 2x8, 5 FOR 2x10, AND 6 FOR 2x12.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A - B	-7089 / 0	-77.4 -77.4	0.19 (1)	X - B	0 / 3020	0.37 (1)	
B - C	-4025 / 0	-77.4 -77.4	0.17 (1)	B - W	-2803 / 0	0.51 (1)	
C - D	-4025 / 0	-77.4 -77.4	0.17 (1)	W - D	0 / 1898	0.23 (1)	
D - E	-2688 / 0	-77.4 -77.4	0.13 (1)	D - V	-1792 / 0	0.73 (1)	
E - F	-1921 / 0	-77.4 -77.4	0.11 (1)	V - E	0 / 1385	0.17 (1)	
F - Z	-1343 / 0	-84.9 -84.9	0.16 (1)	E - U	-1414 / 0	0.44 (1)	
Z - G	-1343 / 0	-84.9 -84.9	0.16 (1)	U - F	0 / 1364	0.12 (1)	
G - H	-1690 / 0	-77.4 -77.4	0.10 (1)	F - S	-564 / 0	0.24 (1)	
H - I	-1689 / 0	-77.4 -77.4	0.10 (1)	S - G	0 / 701	0.06 (1)	
I - J	-1400 / 0	-77.4 -77.4	0.08 (1)	S - H	-46 / 0	0.01 (1)	
J - K	-1400 / 0	-77.4 -77.4	0.08 (1)	R - H	-289 / 0	0.07 (1)	
K - L	-5 / 57	-77.4 -77.4	0.08 (1)	R - I	0 / 408	0.05 (1)	
L - M	0 / 30	-77.4 -77.4	0.05 (1)	P - I	-806 / 0	0.21 (1)	
Y - A	-7407 / 0	0.0 0.0	0.26 (1)	P - K	0 / 1382	0.17 (1)	
N - L	-114 / 0	0.0 0.0	0.01 (1)	O - K	-1912 / 0	0.18 (1)	
				A - X	0 / 6453	0.80 (1)	
				O - L	-28 / 7	0.00 (1)	
Y - X	0 / 0	-18.2 -18.2	0.32 (1)				
X - W	0 / 5670	-18.2 -18.2	0.63 (1)				
W - V	0 / 3234	-18.2 -18.2	0.21 (1)				
V - U	0 / 2152	-18.2 -18.2	0.15 (1)				
U - T	0 / 1536	-18.2 -18.2	0.11 (1)				
T - S	0 / 1536	-18.2 -18.2	0.11 (1)				
S - R	0 / 1354	-18.2 -18.2	0.10 (1)				
R - Q	0 / 1120	-18.2 -18.2	0.08 (1)				
Q - P	0 / 1120	-18.2 -18.2	0.08 (1)				
P - O	-26 / 7	-18.2 -18.2	0.07 (1)				
O - N	0 / 0	-18.2 -18.2	0.07 (1)				

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
	DL = 3.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.3	PSF
TOTAL LOAD	= 33.6	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON PIGGYBACK TRUSS WITH SLOPES OF 6.00/12 AND -6.00/12 AND RESPECTIVE WALL HEIGHTS OF 0-0 AND 0-0 AND AN ADDITIONAL DEAD LOAD OF 3.0 P.S.F.

*** NON STANDARD GIRDER ***
ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.00")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (1.00")
CALCULATED VERT. DEFL.(TL) = L/999 (0.09")

CANTILEVER DEFLECTION:
ALLOWABLE DEFL.(LL)= L/120 (0.22")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/120 (0.22")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.26/1.00 (A-Y:1), BC=0.63/1.00 (W-X:1), WB=0.80/1.00 (A-X:1), SSI=0.22/1.00 (X-Y:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50


AUTOSOLVE RIGHT HEEL ONLY

CONTINUED ON PAGE 2



Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Tue Jun 5 16:52:09 2018 Page 2
Kh8cyzSnzB2V3-xtQK7MkuTB6IPfnidhVEcgEMngB02o3SsoCvKDz9Hk4



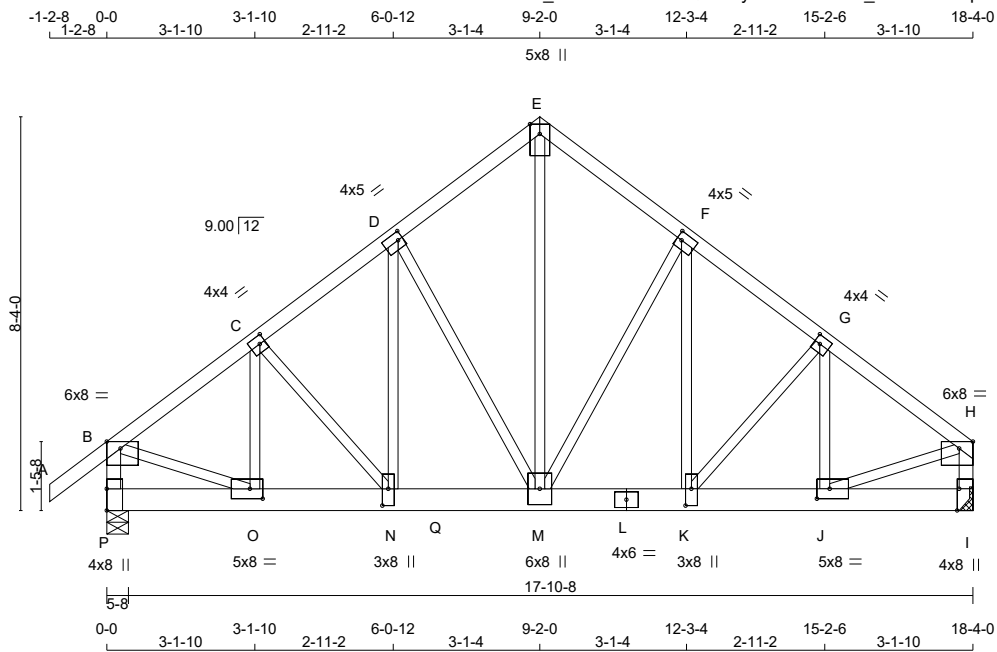

TOTAL WEIGHT = 2 X 104 = 208 lb [M]

LUMBER			
CHORDS	SIZE	DRY	LUMBER
A - E	2x4	DRY	No.2
E - H	2x4	DRY	No.2
P - B	2x4	DRY	No.2
I - H	2x4	DRY	No.2
P - L	2x6	DRY	No.2
L - I	2x6	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF **2** TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - E	12	TOP
E - H	12	TOP
P - B	12	TOP
I - H	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
P - L	8	SIDE(334.1)
L - I	8	SIDE(334.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
P	5403	0	5403	0	5-8
I	7140	0	7140	0	MECHANICAL

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT I TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
P	3794	2643 / 0	0 / 0	0 / 0	0 / 0	1150 / 0	0 / 0
I	5016	3478 / 0	0 / 0	0 / 0	0 / 0	1538 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.55 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	MAX. LC1 (LC)
FR-TO		FROM TO		FR-TO			
A-B	0 / 30	-77.4 -77.4	0.05 (1)	10.00	M-E	0 / 6221	0.77 (1)
B-C	-5910 / 0	-77.4 -77.4	0.19 (1)	3.89	M-F	-1970 / 0	0.72 (1)
C-D	-6744 / 0	-77.4 -77.4	0.22 (1)	3.64	K-F	0 / 2209	0.27 (1)
D-E	-5385 / 0	-77.4 -77.4	0.18 (1)	4.06	K-G	-509 / 0	0.09 (1)
E-F	-5387 / 0	-77.4 -77.4	0.18 (1)	4.06	J-G	0 / 394	0.05 (1)
F-G	-6584 / 0	-77.4 -77.4	0.21 (1)	3.68	D-M	-2223 / 0	0.81 (1)
G-H	-6996 / 0	-77.4 -77.4	0.25 (1)	3.55	N-D	0 / 2537	0.31 (1)
P-B	-5342 / 0	0.0 0.0	0.30 (1)	5.20	C-N	0 / 1006	0.12 (1)
I-H	-6186 / 0	0.0 0.0	0.35 (1)	4.84	O-C	-1511 / 0	0.17 (1)
					B-O	0 / 4989	0.62 (1)
					J-H	0 / 5902	0.73 (1)
P-O	0 / 0	-18.2 -18.2	0.04 (1)	10.00			
O-N	0 / 4732	-18.2 -18.2	0.39 (1)	10.00			
N-Q	0 / 5389	-18.2 -18.2	0.64 (1)	10.00			
Q-M	0 / 5389	-686.5 -686.5	0.64 (1)	10.00			
M-L	0 / 5266	-686.5 -686.5	0.63 (1)	10.00			
L-K	0 / 5266	-686.5 -686.5	0.63 (1)	10.00			
K-J	0 / 5598	-686.5 -686.5	0.53 (1)	10.00			
J-I	0 / 0	-686.5 -686.5	0.24 (1)	10.00			

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
N	6-0-12	-3116	-3116	---	BACK	VERT	TOTAL

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN./C

GIRDER TYPE: CStdGirder
START DISTANCE = 7-0-0
START SPAN CARRIED = 30-5-0
END DISTANCE = 18-4-0
END SPAN CARRIED = 30-5-0
END WALL WIDTH = 5-8
APPLIED TO BACK SIDE OF BOTTOM CHORD.
- ADDTL LOADS BASED ON 55 % OF GSL.

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.61")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL)= L/360 (0.61")
CALCULATED VERT. DEFL.(TL) = L/999 (0.15")

CSI: TC=0.35/1.00 (H-I:1), BC=0.64/1.00 (M-N:1),
WB=0.81/1.00 (D-M:1), SS=0.43/1.00 (M-N:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



CONTINUED ON PAGE 2



PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	6.0	8.0	Edge	3.50
C	TMWW-t	MT20	4.0	4.0	2.00	1.50
D	TMWW-t	MT20	4.0	5.0	2.00	1.25
E	TTW+p	MT20	5.0	8.0	Edge	
F	TMWW-t	MT20	4.0	5.0	2.00	1.25
G	TMWW-t	MT20	4.0	4.0	2.00	1.50
H	TMVW-p	MT20	6.0	8.0	Edge	3.50
I	BMV1+t	MT20	4.0	8.0	Edge	0.50
J	BMWW-t	MT20	5.0	8.0	2.50	3.25
K	BMWW+t	MT20	3.0	8.0	4.25	1.50
L	BS-t	MT20	4.0	6.0		
M	BMWWWW+t	MT20	6.0	8.0		
N	BMWW+t	MT20	3.0	8.0	4.25	1.50
O	BMWW-t	MT20	5.0	8.0	2.50	3.25
P	BMV1+t	MT20	4.0	8.0	5.50	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 3115.7 lbs FACTORED DOWN AT 6-0-12 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX MIN
MT20	618	354	1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (J) (INPUT = 0.90)

JSI METAL= 0.79 (L) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



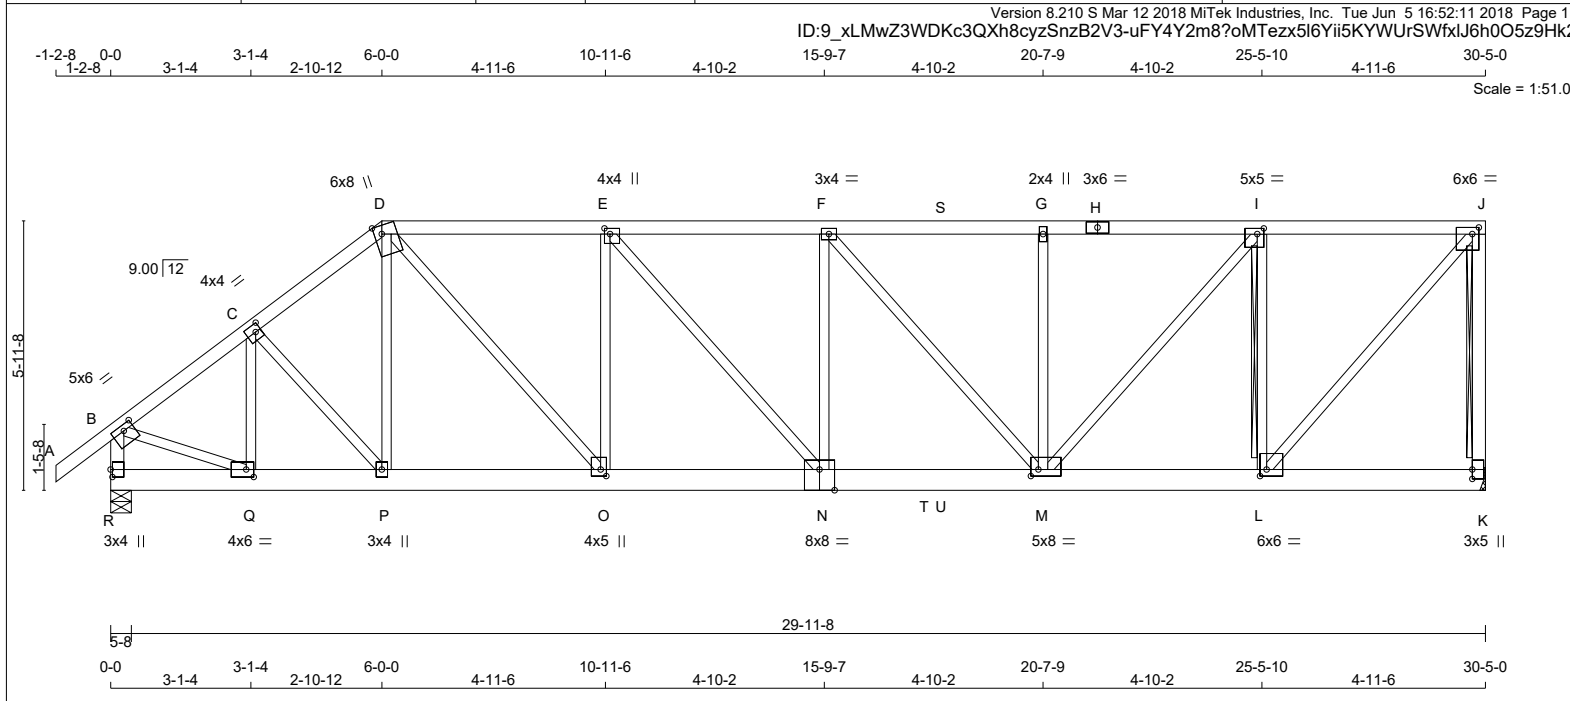

TOTAL WEIGHT = 157 lb [M]

N. L. G. A. RULES					BUILDING DESIGNER										DESIGN CRITERIA				
CHORDS		SIZE		LUMBER	DESCR.	BEARINGS													
A - D		2x4	DRY	No.2	SPF	FACTORED		MAXIMUM FACTORED		INPUT		REQRD		*** SPECIAL LOADS ANALYSIS ***					
D - H		2x4	DRY	No.2	SPF	GROSS REACTION		GROSS REACTION		BRG		BRG		GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.					
H - J		2x4	DRY	No.2	SPF	JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	LOADS WERE DERIVED FROM USER INPUT					
K - J		2x4	DRY	No.2	SPF	K	3116	0	3116	0	0	MECHANICAL		NO FURTHER MODIFICATIONS WERE MADE					
R - B		2x4	DRY	No.2	SPF	R	2333	0	2333	0	0	5-8							
R - N		2x6	DRY	2100F 1.8E	SPF	A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT K TO RESIST THE MAX FACTORED REACTIONS.										SPECIFIED LOADS:			
N - K		2x6	DRY	2100F 1.8E	SPF											TOP CH. LL = 23.3 PSF			
ALL WEBS		2x3	DRY	No.2	SPF											DL = 3.0 PSF			

DRY: SEASONED LUMBER.

UNFACTORED REACTIONS							
1ST LCASE	MAX/MIN	COMPONENT REACTIONS					
JT COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
K 2189	1518 / 0	0 / 0	0 / 0	0 / 0	671 / 0	0 / 0	
R 1637	1148 / 0	0 / 0	0 / 0	0 / 0	489 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.42 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT J-K, I-L

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING			
TOTAL LOAD CASES: (4)			

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	

FR-TO	FROM	TO	UNBRACED LENGTH	FR-TO	FROM	TO	UNBRACED LENGTH
A-B	0 / 30	-77.4	-77.4 0.10 (1)	10.00	Q-C	-690 / 0	0.16 (1)
B-C	-2373 / 0	-77.4	-77.4 0.19 (1)	4.27	C-P	0 / 320	0.08 (1)
C-D	-2674 / 0	-77.4	-77.4 0.21 (1)	4.03	P-D	-45 / 40	0.02 (1)
D-E	-3359 / 0	-77.4	-77.4 0.53 (1)	3.36	D-O	0 / 1865	0.46 (1)
E-F	-4296 / 0	-77.4	-77.4 0.67 (1)	2.86	O-E	-1490 / 0	0.79 (1)
F-S	-4029 / 0	-77.4	-77.4 0.69 (1)	2.89	E-N	0 / 1430	0.35 (1)
S-G	-4029 / 0	-145.9	-145.9 0.69 (1)	2.89	N-F	-78 / 50	0.04 (1)
G-H	-4029 / 0	-145.9	-145.9 0.95 (1)	2.42	F-M	-408 / 0	0.43 (1)
H-I	-4029 / 0	-145.9	-145.9 0.95 (1)	2.42	M-G	-643 / 0	0.34 (1)
I-J	-2419 / 0	-145.9	-145.9 0.72 (1)	3.49	M-I	0 / 2458	0.61 (1)
K-J	-3018 / 0	0.0	0.0 0.60 (1)	7.81	L-I	-2674 / 0	0.70 (1)
R-B	-2274 / 0	0.0	0.0 0.25 (1)	5.60	L-J	0 / 3648	0.90 (1)
					B-Q	0 / 2014	0.50 (1)
R-Q	0 / 0	-18.2	-18.2 0.04 (1)	10.00			
Q-P	0 / 1909	-18.2	-18.2 0.15 (1)	10.00			
P-O	0 / 2121	-18.2	-18.2 0.17 (1)	10.00			
O-N	0 / 3359	-18.2	-18.2 0.38 (1)	10.00			
N-T	0 / 4296	-18.2	-18.2 0.76 (1)	10.00			
T-U	0 / 4296	-18.2	-18.2 0.76 (1)	10.00			
U-M	0 / 4296	-34.4	-34.4 0.76 (1)	10.00			
M-L	0 / 2419	-34.4	-34.4 0.29 (1)	10.00			
L-K	0 / 0	-34.4	-34.4 0.06 (4)	10.00			

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

Jun 05, 2018

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
T	18-0-12	-1425	-1425	---	FRONT	VERT	TOTAL

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN YORK HOMES - GRANELLI HOME CORP - INDIGO 1 ELEV 1	DRWG NO.
NE0618-034	G04	1	1	TRUSS DESC.		PAGE 10 OF 61

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Tue Jun 5 16:52:11 2018 Page 2
ID:9 xLMwZ3WDKc3QXh8cyzSszB2V3-uFY4Y2m8?oMTeZx5l6YiI5KYWUrSWfxIJ6h0O5z9Hk2

HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S)
REQUIRED TO SUPPORT CONCENTRATED
LOAD(S) 1424.8 lbs FACTORED DOWN AT
18'-0"-12 ON BOTTOM CHORD. DESIGN FOR
UNSPECIFIED CONNECTION(S) IS DELEGATED
TO THE BUILDING DESIGNER.

TRUSS PLATE MANUFACTURER IS NOT
RESPONSIBLE FOR QUALITY CONTROL IN
THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (B) (INPUT = 0.90)
JSI METAL= 0.69 (N) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Tue Jun 5 16:52:12 2018 Page 1
ID:9_xLMwZ3WVKc3QXh8cyzSnzB2V3-MS6SmOmm6UKG7WHlp3xEIswBuHHFFvYmQZxYz9Hk1

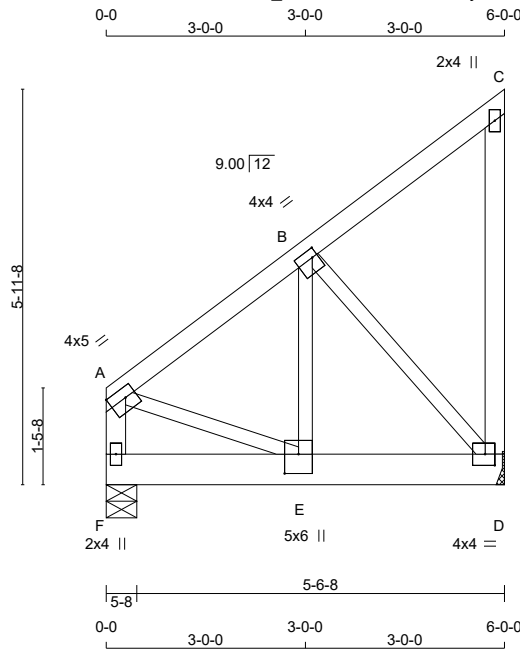

TOTAL WEIGHT = 34 lb [M]

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF
F - A	2x4	DRY	No.2	SPF
F - D	2x6	DRY	No.2	SPF

ALL WEBS EXCEPT 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	4.0	5.0	1.75	Edge
B	TMWW-t	MT20	4.0	4.0	1.50	1.00
C	TMV-p	MT20	2.0	4.0		
D	BMVW1-t	MT20	4.0	4.0	2.00	1.75
E	BMWW-t	MT20	5.0	6.0	3.50	2.50
F	BMV1-p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
D	1425	0	1425	0	0	MECHANICAL
F	1425	0	1425	0	0	5-8

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT D TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
D	1001	694 / 0	0 / 0	0 / 0	0 / 0	307 / 0	0 / 0	
F	1001	694 / 0	0 / 0	0 / 0	0 / 0	307 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.21 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORIZ. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM	TO		FR-TO			
A-B	-944 / 0	-77.4	-77.4	0.13 (1)	6.21	E-B	0 / 1137	
B-C	-15 / 0	-77.4	-77.4	0.11 (1)	6.25	B-D	-1140 / 0	
D-C	-92 / 0	0.0	0.0	0.06 (1)	7.81	A-E	0 / 813	
F-A	-935 / 0	0.0	0.0	0.10 (1)	7.81			
F-E	0 / 0	-397.7	-397.7	0.23 (1)	10.00			
E-D	0 / 767	-397.7	-397.7	0.33 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	PSF
DL	23.3	PSF
DL	3.0	PSF
BOT CH.	LL	PSF
DL	0.0	PSF
DL	7.3	PSF
TOTAL LOAD	33.6	PSF

SPACING = 24.0 IN. C/C

GIRDER TYPE: CStd Girder
START DISTANCE = 0-0
START SPAN CARRIED = 18-0-0
END DISTANCE = 6-0-0
END SPAN CARRIED = 18-0-0
END WALL WIDTH = 1-8
APPLIED TO FRONT SIDE OF BOTTOM CHORD.
- ADD'L LOADS BASED ON 55 % OF GSL.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/999 (0.02")

CSI: TC=0.13/1.00 (A-B:1), BC=0.33/1.00 (D-E:1), WB=0.36/1.00 (B-D:1), SSI=0.47/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

CONTINUED ON PAGE 2

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN YORK HOMES - GRANELLI HOME CORP - INDIGO 1 ELEV 1	DRWG NO.
NE0618-034	G05	1	1	TRUSS DESC.		PAGE 12 OF 61

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Tue Jun 5 16:52:12 2018 Page 2
ID:9_xLMwZ3WDKc3QXh8cyzSnzB2V3-MS6SmOmm6UKG7WHlp3xEIswBuHHFFvYmQZxYz9Hk1

JSI GRIP= 0.87 (B) (INPUT = 0.90)
JSI METAL= 0.30 (A) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



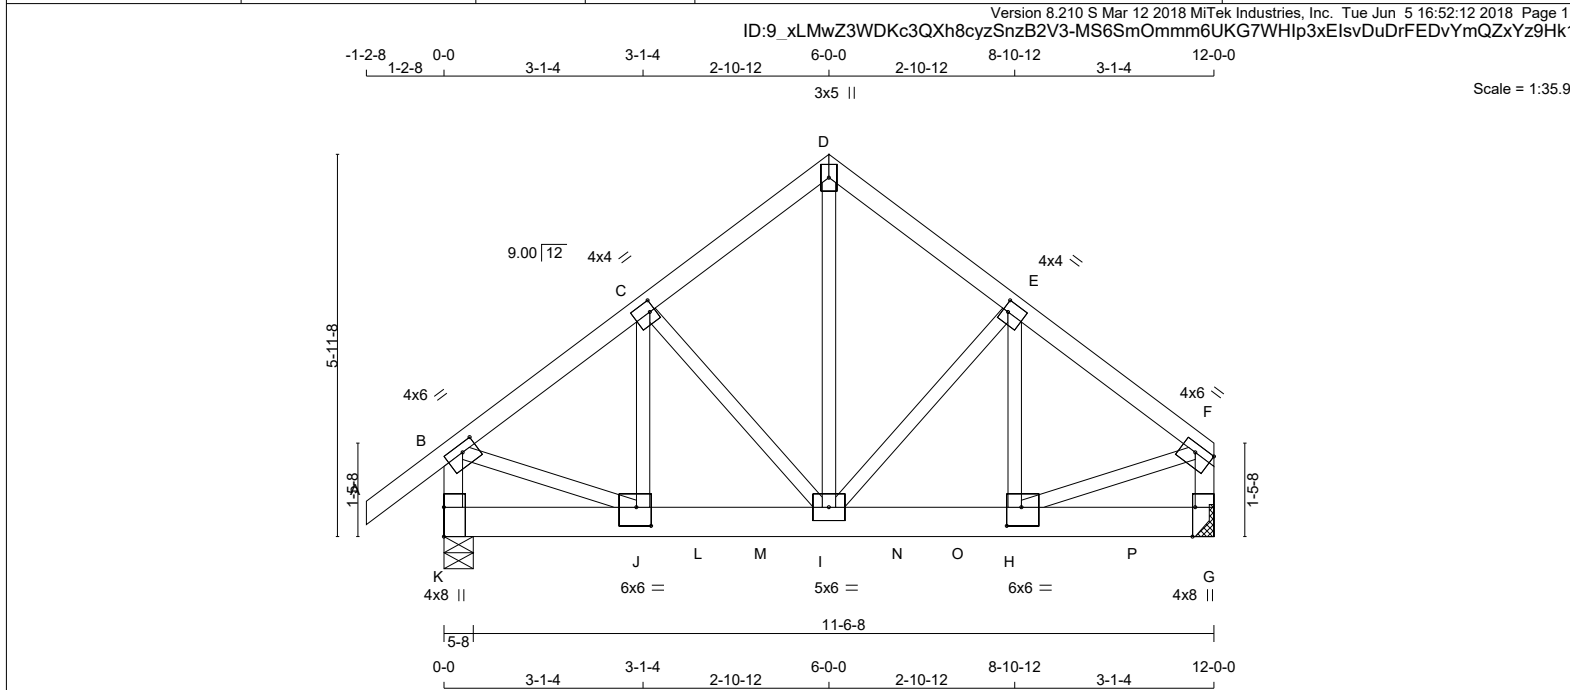

TOTAL WEIGHT = 2 X 63 = 126 lb [M]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
K - B	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
K - G	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF **2** TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - D	12	TOP
D - F	12	TOP
K - B	12	TOP
G - F	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
K - G	12	SIDE(204.2)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	GROSS REACTION	VERT	HORZ	DOWN	HORZ	BRG	IN-SX	BRG	IN-SX
K	2362	0	2362	0	0	5-8	5-8		
G	4771	0	4771	0	0	MECHANICAL			

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT G TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
K	1657	1162 / 0	0 / 0	0 / 0	0 / 0	0 / 0	495 / 0	0 / 0
G	3352	2324 / 0	0 / 0	0 / 0	0 / 0	0 / 0	1028 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.81 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC1)	
FR-TO		FROM	TO	UNBRAC LENGTH	FR-TO		
A-B	0 / 30	-77.4	-77.4 0.05 (1)	10.00	I-D	0 / 2692	0.33 (1)
B-C	-2449 / 0	-77.4	-77.4 0.08 (1)	5.70	I-E	-1610 / 0	0.27 (1)
C-D	-2419 / 0	-77.4	-77.4 0.07 (1)	5.74	H-E	0 / 1759	0.22 (1)
D-E	-2415 / 0	-77.4	-77.4 0.07 (1)	5.74	C-I	-59 / 0	0.01 (1)
E-F	-3715 / 0	-77.4	-77.4 0.11 (1)	4.81	J-C	-189 / 0	0.02 (1)
K-B	-2343 / 0	0.0	0.0 0.13 (1)	7.33	B-J	0 / 2075	0.26 (1)
G-F	-3348 / 0	0.0	0.0 0.19 (1)	6.37	H-F	0 / 3141	0.39 (1)
K-J	0 / 0	-18.2	-18.2 0.01 (4)	10.00			
J-L	0 / 1966	-18.2	-18.2 0.27 (1)	10.00			
L-M	0 / 1966	-18.2	-18.2 0.27 (1)	10.00			
M-I	0 / 1966	-231.4	-231.4 0.27 (1)	10.00			
I-N	0 / 2976	-18.2	-18.2 0.49 (1)	10.00			
N-O	0 / 2976	-18.2	-18.2 0.49 (1)	10.00			
O-H	0 / 2976	-426.6	-426.6 0.49 (1)	10.00			
H-P	0 / 0	-426.6	-426.6 0.62 (1)	10.00			
P-G	0 / 0	-18.2	-18.2 0.62 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
L	4-0-12	-747	-747	---	FRONT	VERT	TOTAL
N	7-1-12	-1519	-1519	---	FRONT	VERT	TOTAL
P	10-9-12	-2292	-2292	---	FRONT	VERT	TOTAL

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
	DL = 3.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.3	PSF
TOTAL LOAD	= 33.6	PSF

SPACING = 24.0 IN. C/C

GIRDER TYPE: CStdGirder
START DISTANCE = 5-0-0
START SPAN CARRIED = 10-11-0
END DISTANCE = 6-2-8
END SPAN CARRIED = 10-11-0
END WALL WIDTH = 0-0
APPLIED TO FRONT SIDE OF BOTTOM CHORD.
- ADDTL LOADS BASED ON 55 % OF GSL.

GIRDER TYPE: CStdGirder
START DISTANCE = 8-1-0
START SPAN CARRIED = 19-1-0
END DISTANCE = 10-10-8
END SPAN CARRIED = 19-1-0
END WALL WIDTH = 0-0
APPLIED TO FRONT SIDE OF BOTTOM CHORD.
- ADDTL LOADS BASED ON 55 % OF GSL.

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.40")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL)= L/360 (0.40")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.19/1.00 (F-G:1), BC=0.62/1.00 (G-H:1), WB=0.39/1.00 (F-H:1), SSI=0.57/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

CONTINUED ON PAGE 2

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	6.0	1.50	2.75
C	TMWW-t	MT20	4.0	4.0	2.00	1.00
D	TTW+p	MT20	3.0	5.0		
E	TMWW-t	MT20	4.0	4.0	2.00	1.00
F	TMVW-t	MT20	4.0	6.0	1.50	Edge
G	BMV1+t	MT20	4.0	8.0	Edge	0.50
H	BMWW-t	MT20	6.0	6.0	3.50	2.75
I	BMWWW-t	MT20	5.0	6.0		
J	BMWW-t	MT20	6.0	6.0	3.50	2.75
K	BMV1+t	MT20	4.0	8.0	5.50	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES

1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 747.3 lbs FACTORED DOWN AT 4-0-12, AND 1518.7 lbs FACTORED DOWN AT 7-1-12, AND 2291.6 lbs FACTORED DOWN AT 10-9-12 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (D) (INPUT = 0.90)

JSI METAL= 0.47 (B) (INPUT = 1.00)


READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
NE0618-034	G07	1	1	GREEN YORK HOMES - GRANELLI HOME CORP - INDIGO 1 ELEV 1	PAGE 15 OF 61

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Tue Jun 5 16:52:13 2018 Page 1

ID:9_xLMwZ3WDKc3QXh8cyzSnzB2V3-qefqzknPXQcBuH5TsWaAnWP?sHYD_cw2nQA7T_z9Hk0

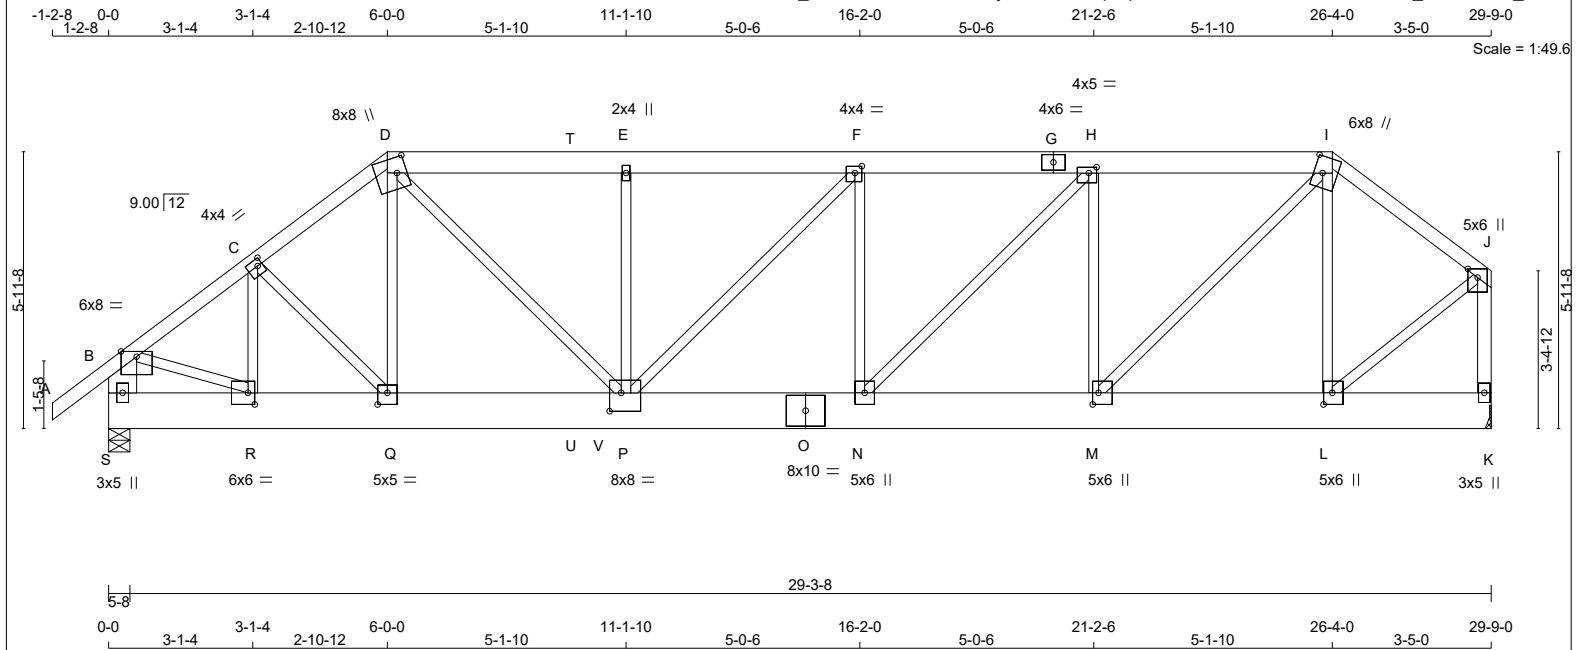

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - D	2x4	DRY	No.2	SPF
D - G	2x6	DRY	No.2	SPF
G - I	2x6	DRY	No.2	SPF
I - J	2x4	DRY	No.2	SPF
S - B	2x8	DRY	No.2	SPF
K - J	2x4	DRY	No.2	SPF
S - O	2x10	DRY	No.2	SPF
O - K	2x10	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	6.0	8.0	Edge	
C	TMWW-t	MT20	4.0	4.0	1.75	1.25
D	TTWW+m	MT20	8.0	8.0	4.00	2.50
E	TMW+w	MT20	2.0	4.0		
F	TMWW-t	MT20	4.0	4.0	1.75	1.75
G	TS-t	MT20	4.0	6.0		
H	TMWW-t	MT20	4.0	5.0	1.50	2.00
I	TTWW+m	MT20	6.0	8.0	4.25	2.25
J	TMVW+p	MT20	5.0	6.0	2.25	2.50
K	BMV1+p	MT20	3.0	5.0		
L	BMWW+t	MT20	5.0	6.0	3.00	2.25
M	BMWW+t	MT20	5.0	6.0	3.00	1.50
N	BMWW+t	MT20	5.0	6.0		
O	BS-t	MT20	8.0	10.0		
P	BMWWW-t	MT20	8.0	8.0	4.75	3.00
Q	BMWW-t	MT20	5.0	5.0	3.00	2.50
R	BMWW-t	MT20	6.0	6.0	3.00	1.75
S	BMV1+p	MT20	3.0	5.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	UP
S	3397	0	3397	0
K	2292	0	2292	0

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT K TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	2ND LCASE	MAX/MIN. COMPONENT REACTIONS
S	COMBINED	SNOW	LIVE	PERM.LIVE
S	2387	1656 / 0	0 / 0	0 / 0
K	1610	1120 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.14 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MAX. FACTORED		FACTORED			MAX. FACTORED				
MEMB.	FORCE	VERT. LOAD	LC1	MAX.	MAX.	MEMB.	FORCE	MAX.	
	(LBS)	(PLF)	(LC)		UNBRACED		(LBS)	(LC)	
FR-TO		FROM	TO	LENGTH	FR-TO				
A-B	0 / 30	-77.4	-77.4	0.10 (1)	10.00	R-C	-1176 / 0	0.24 (1)	
B-C	-3596 / 0	-77.4	-77.4	0.29 (1)	3.46	C-Q	0 / 750	0.19 (1)	
C-D	-4243 / 0	-77.4	-77.4	0.34 (1)	3.14	Q-D	0 / 225	0.08 (4)	
D-T	-4884 / 0	-145.9	-145.9	0.45 (1)	3.53	D-P	0 / 2144	0.53 (1)	
T-E	-4884 / 0	-77.4	-77.4	0.45 (1)	3.53	P-E	-576 / 0	0.25 (1)	
E-F	-4884 / 0	-77.4	-77.4	0.30 (1)	3.71	P-F	0 / 1039	0.26 (1)	
F-G	-4172 / 0	-77.4	-77.4	0.25 (1)	4.03	N-F	-1112 / 0	0.48 (1)	
G-H	-4172 / 0	-77.4	-77.4	0.25 (1)	4.03	N-H	0 / 1671	0.41 (1)	
H-I	-3027 / 0	-77.4	-77.4	0.20 (1)	4.66	M-H	-1674 / 0	0.73 (1)	
I-J	-1757 / 0	-77.4	-77.4	0.22 (1)	4.78	M-I	0 / 2364	0.59 (1)	
S-B	-3194 / 0	0.0	0.0	0.17 (1)	6.59	L-I	-942 / 0	0.41 (1)	
K-J	-2313 / 0	0.0	0.0	0.38 (1)	5.55	B-R	0 / 3003	0.74 (1)	
						L-J	0 / 1809	0.45 (1)	
S-R	0 / 0	-34.4	-34.4	0.15 (1)	10.00				
R-Q	0 / 2886	-34.4	-34.4	0.42 (1)	10.00				
Q-U	0 / 3402	-34.4	-34.4	0.67 (1)	10.00				
U-V	0 / 3402	-18.2	-18.2	0.67 (1)	10.00				
V-P	0 / 3402	-18.2	-18.2	0.67 (1)	10.00				
P-O	0 / 4172	-18.2	-18.2	0.45 (1)	10.00				
O-N	0 / 4172	-18.2	-18.2	0.45 (1)	10.00				
N-M	0 / 3027	-18.2	-18.2	0.33 (1)	10.00				
M-L	0 / 1392	-18.2	-18.2	0.19 (1)	10.00				
L-K	0 / 0	-18.2	-18.2	0.06 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
D	6-0-0	-348	-348	---	BACK	VERT	TOTAL
V	10-7-4	-1961	-1961	---	BACK	VERT	TOTAL

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.3	PSF
TOTAL LOAD	=	33.6	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

GIRDER TYPE: CPrimeHip
LEFT SETBACK = 6-0-0
RIGHT SETBACK = 3-5-0
END SETBACK = 6-0-0
END WALL WIDTH = 5-8
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO BACK SIDE
- ADDTL LOADS BASED ON 55 % OF GSL.
LOADS APPLIED TO FIRST 10-0-0 OF SPAN MEASURED FROM THE LEFT.

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.99")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL)= L/360 (0.99")
CALCULATED VERT. DEFL.(TL) = L/999 (0.25")

CSI: TC=0.45/1.00 (D-E:1), BC=0.67/1.00 (P-Q:1), WB=0.74/1.00 (B-R:1), SSI=0.85/1.00 (P-Q:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

CONTINUED ON PAGE 2

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN YORK HOMES - GRANELLI HOME CORP - INDIGO 1 ELEV 1	DRWG NO.
NE0618-034	G07	1	1	TRUSS DESC.		PAGE 16 OF 61

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Tue Jun 5 16:52:13 2018 Page 2
ID:9 xLMwZ3WDKc3QXh8cyzSnzB2V3-qefgzknPXQcBuH5TsWaAnWP?sHYD cw2nQA7T_z9Hk0

HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S)
REQUIRED TO SUPPORT CONCENTRATED
LOAD(S) 348.1 lbs FACTORED DOWN AT 6-0-0
ON TOP CHORD, AND 1961.4 lbs FACTORED
DOWN AT 10-7-4 ON BOTTOM CHORD. DESIGN
FOR UNSPECIFIED CONNECTION(S) IS
DELEGATED TO THE BUILDING DESIGNER.

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT
RESPONSIBLE FOR QUALITY CONTROL IN
THE TRUSS MANUFACTURING PLANT .

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX MIN
MT20	618	354 1667	822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (I) (INPUT = 0.90)
JSI METAL= 0.72 (R) (INPUT = 1.00)



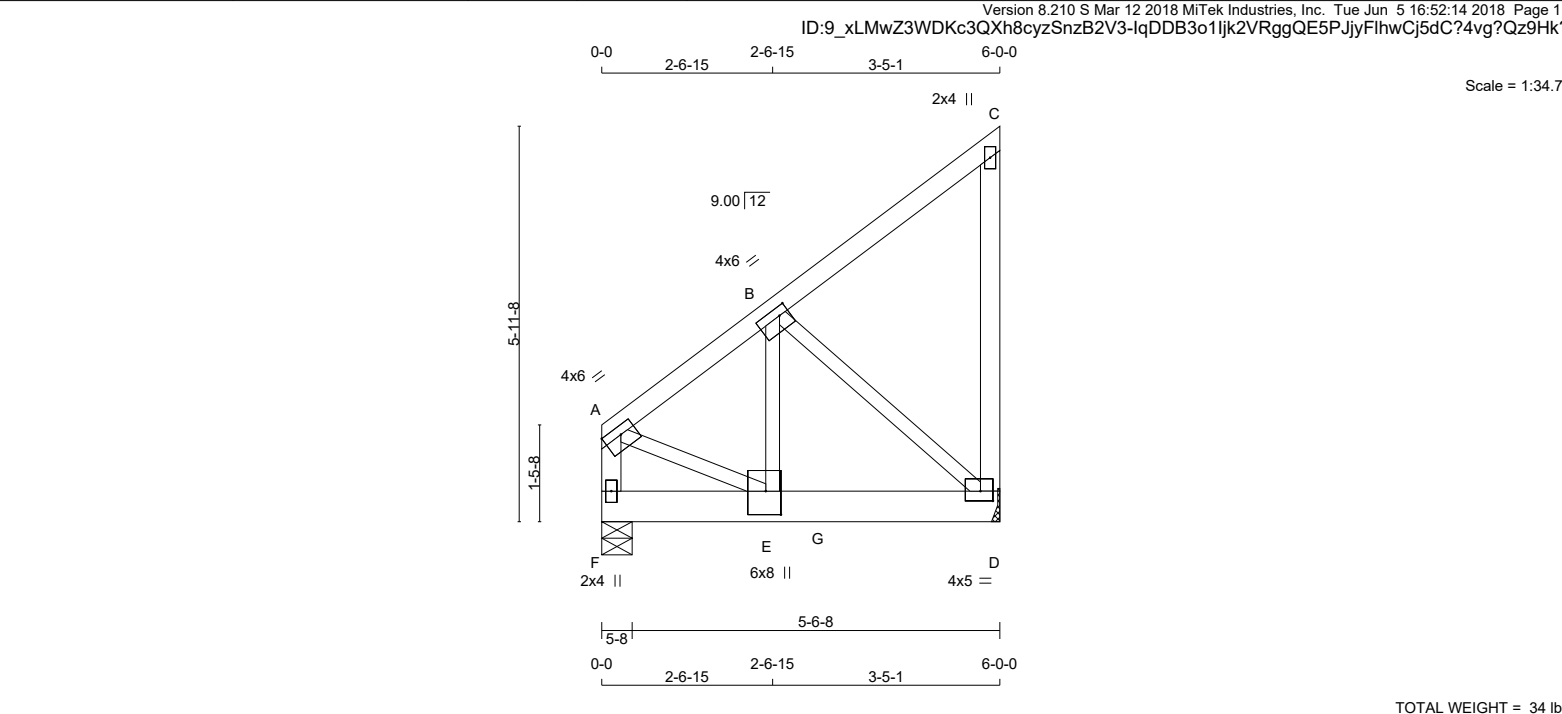

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF
F - A	2x4	DRY	No.2	SPF
F - D	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 EXCEPT SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	4.0	6.0	1.50	Edge
B	TMWW-t	MT20	4.0	6.0	1.50	1.75
C	TMV+p	MT20	2.0	4.0		
D	BMVW1-t	MT20	4.0	5.0	1.75	2.25
E	BMWW+t	MT20	6.0	8.0	4.25	2.75
F	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES

1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 1927.2 lbs FACTORED DOWN AT 2-4-12 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
D	1961	0	1961	0
F	1629	0	1629	0

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT D TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED
D	1378
F	1144

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.96 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	-1681 / 0	-77.4	-77.4 0.15 (1)	E-B	0 / 1921	0.48	(1)
B-C	-12 / 0	-77.4	-77.4 0.12 (1)	B-D	-1800 / 0	0.59	(1)
D-C	-112 / 0	0.0	0.0 0.07 (1)	A-E	0 / 1466	0.36	(1)
F-A	-1643 / 0	0.0	0.0 0.18 (1)				
F-E	0 / 0	-18.2	-18.2 0.07 (1)				
E-G	0 / 1358	-18.2	-18.2 0.56 (1)				
G-D	0 / 1358	-426.6	-426.6 0.56 (1)				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
E	2-4-12	-1927	-1927	---	BACK	VERT	TOTAL

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN YORK HOMES - GRANELLI HOME CORP - INDIGO 1 ELEV 1	DRWG NO.
NE0618-034	G08	1	1	TRUSS DESC.		PAGE 18 OF 61

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Tue Jun 5 16:52:14 2018 Page 2
ID:9_xLMwZ3WDKc3QXh8cyzSnzB2V3-lqDDB3o1Ijk2VRggQE5PJyFlhwCj5dC?4vg?Qz9Hk?

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (D) (INPUT = 0.90)
JSI METAL= 0.43 (A) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



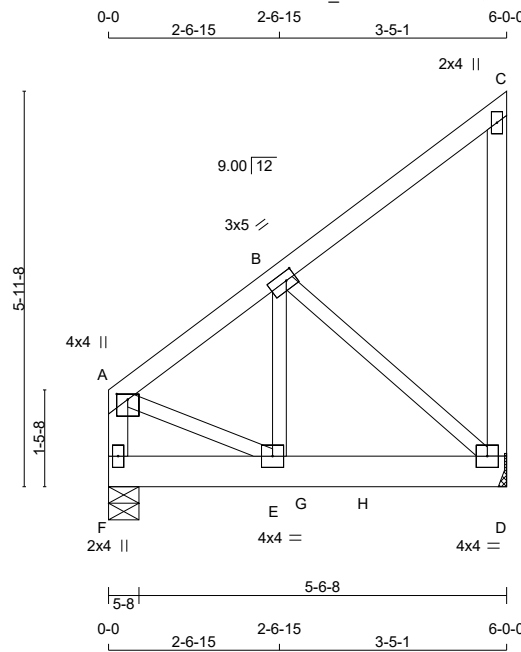

Scale = 1:34.7

TOTAL WEIGHT = 34 lb [M]

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF
F - A	2x4	DRY	No.2	SPF
F - D	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.00	2.00
B	TMWW-t	MT20	3.0	5.0	1.50	1.75
C	TMV+p	MT20	2.0	4.0		
D	BMVW1-t	MT20	4.0	4.0		
E	BMWW-t	MT20	4.0	4.0		
F	BMV1+p	MT20	2.0	4.0		

HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 707.4 lbs FACTORED DOWN AT 2-11-12 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	DOWN	IN-SX	IN-SX
D	1005	0	0	MECHANICAL
F	720	0	0	5-8

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT D TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
D	706	490 / 0	0 / 0	0 / 0	0 / 0	217 / 0	0 / 0
F	506	351 / 0	0 / 0	0 / 0	0 / 0	155 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MAX. UNBRACED LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)		
FR-TO		FROM TO			FR-TO				
A-B	-734 / 0	-77.4	-77.4	0.13 (1)	6.25	E-B	0 / 688	0.17 (1)	
B-C	-14 / 0	-77.4	-77.4	0.12 (1)	6.25	B-D	-799 / 0	0.26 (1)	
D-C	-108 / 0	0.0	0.0	0.07 (1)	7.81	A-E	0 / 650	0.16 (1)	
F-A	-765 / 0	0.0	0.0	0.09 (1)	7.81				
F-E	0 / 0	-18.2	-18.2	0.13 (1)	10.00				
E-G	0 / 603	-18.2	-18.2	0.30 (1)	10.00				
G-H	0 / 603	-18.2	-18.2	0.30 (1)	10.00				
H-D	0 / 603	-231.4	-231.4	0.30 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
G	2-11-12	-707	-707	---	BACK	VERT	TOTAL

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN./C

GIRDER TYPE: CStdGirder
START DISTANCE = 3-11-0
START SPAN CARRIED = 10-11-0
END DISTANCE = 6-0-0
END SPAN CARRIED = 10-11-0
END WALL WIDTH = 0-0
APPLIED TO BACK SIDE OF BOTTOM CHORD.
- ADDTL LOADS BASED ON 55 % OF GSL.

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.13/1.00 (A-B:1), BC=0.30/1.00 (D-E:1), WB=0.26/1.00 (B-D:1), SI=0.56/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

CONTINUED ON PAGE 2

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN YORK HOMES - GRANELLI HOME CORP - INDIGO 1 ELEV 1	DRWG NO.
NE0618-034	G08A	1	1	TRUSS DESC.		PAGE 20 OF 61

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.82 (B) (INPUT = 0.90)
JSI METAL= 0.23 (E) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



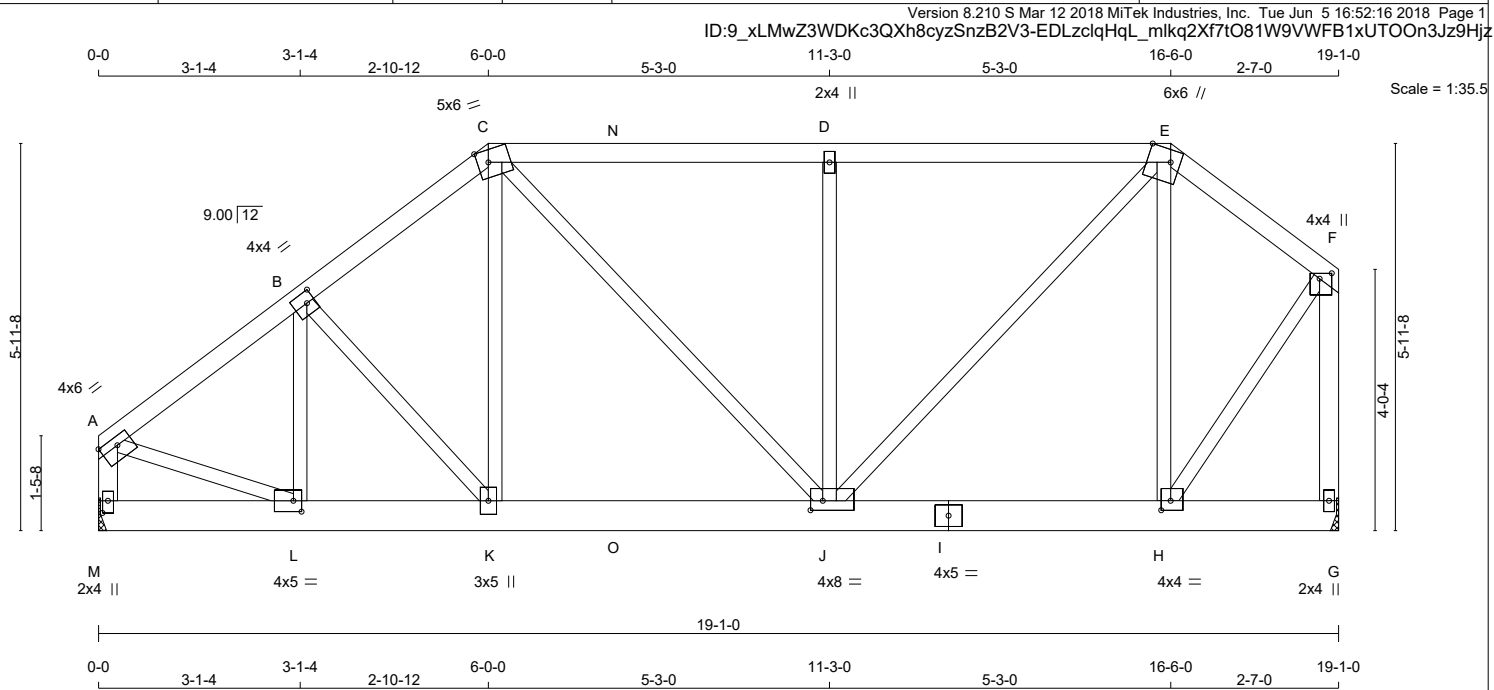

TOTAL WEIGHT = 100 lb

LUMBER				
N. L. G. A. RULES				
CHORDS		SIZE	LUMBER	
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
M - A	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
M - I	2x6	DRY	No.2	SPF
I - G	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				W	LEN	Y	X
JT	TYPE	PLATES					
A	TMVW-t	MT20	4.0	6.0	1.50	Edge	
B	TMVW-t	MT20	4.0	4.0	2.00	1.50	
C	TTWW-m	MT20	5.0	6.0		Edge	2.00
D	TMW+w	MT20	2.0	4.0			
E	TTWW+m	MT20	6.0	6.0		Edge	4.25
F	TMVW+p	MT20	4.0	4.0	1.00	2.25	
G	BMV1+p	MT20	2.0	4.0			
H	BMVW-t	MT20	4.0	4.0	1.75	1.75	
I	BS-t	MT20	4.0	5.0			
J	BMVWWW-t	MT20	4.0	8.0	1.75	2.25	
K	BMVW+t	MT20	3.0	5.0			
L	BMVW-t	MT20	4.0	5.0	2.00	1.50	
M	BMV1+p	MT20	2.0	4.0	2.25	1.00	

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

HANGERS NOTES

- 1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 348.1 lbs FACTORED DOWN AT 6'-0" ON TOP CHORD, AND 1004.9 lbs FACTORED DOWN AT 8'-0" ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
M	1923	0	1923	0	0	MECHANICAL	
G	1520	0	1520	0	0	MECHANICAL	

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT M, G TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
M	1354	925 / 0	0 / 0	0 / 0	0 / 0	429 / 0	0 / 0
G	1067	746 / 0	0 / 0	0 / 0	0 / 0	321 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.35 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MAX. FACTORED		FACTORED		MAX. FACTORED		FACTORED		
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC	MEMB.	FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM TO		LENGTH	FR-TO			
A-B	-1969 / 0	-77.4	-77.4	0.16 (1)	4.64	L-B	-709 / 0	0.16 (1)
B-C	-2283 / 0	-77.4	-77.4	0.17 (1)	4.35	B-K	0 / 339	0.08 (1)
C-N	-1710 / 0	-145.9	-145.9	0.51 (1)	4.43	K-C	0 / 787	0.19 (1)
N-D	-1710 / 0	-77.4	-77.4	0.51 (1)	4.43	C-J	-167 / 0	0.19 (1)
D-E	-1710 / 0	-77.4	-77.4	0.51 (1)	4.43	J-D	-527 / 0	0.28 (1)
E-F	-826 / 0	-77.4	-77.4	0.11 (1)	6.25	J-E	0 / 1556	0.39 (1)
M-A	-1823 / 0	0.0	0.0	0.20 (1)	6.15	H-E	-889 / 0	0.47 (1)
G-F	-1484 / 0	0.0	0.0	0.38 (1)	6.69	A-L	0 / 1673	0.41 (1)
						H-F	0 / 1103	0.27 (1)
M-L	0 / 0	-34.4	-34.4	0.11 (1)	10.00			
L-K	0 / 1585	-34.4	-34.4	0.61 (1)	10.00			
K-O	0 / 1825	-34.4	-34.4	0.84 (1)	10.00			
O-J	0 / 1825	-18.2	-18.2	0.84 (1)	10.00			
J-I	0 / 642	-18.2	-18.2	0.30 (1)	10.00			
I-H	0 / 642	-18.2	-18.2	0.30 (1)	10.00			
H-G	0 / 0	-18.2	-18.2	0.03 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
C	6-0-0	-348	-348	---	BACK	VERT	TOTAL
Q	8-0-8	-1005	-1005	---	BACK	VERT	TOTAL

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED
BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.3	PSF
TOTAL LOAD	=	33.6	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A
SLOPE OF 2.00/12 MINIMUM

GIRDER TYPE: CPrimeHip
LEFT SETBACK = 6-0-0
RIGHT SETBACK = 2-7-0
END SETBACK = 6-0-0
END WALL WIDTH = 5-8
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO BACK SIDE
- ADD'T'L LOADS BASED ON .55 % OF GSL.
LOADS APPLIED TO FIRST 8-0-0 OF SPAN
MEASURED FROM THE LEFT.

*** NON STANDARD GIRDER ***
ADDT'L USER-DEFINED LOADS APPLIED TO
ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.64")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.08")
ALLOWABLE DEFL.(TL)= L/360 (0.64")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.15")

CSI: TC=0.51/1.00 (C-D:1), BC=0.84/1.00 (J-K:1),
WB=0.47/1.00 (E-H:1), SSI=0.50/1.00 (J-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

CONTINUED ON PAGE 2



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN YORK HOMES - GRANELLI HOME CORP - INDIGO 1 ELEV 1	DRWG NO.
NE0618-034	G09	1	1	TRUSS DESC.		PAGE 22 OF 61

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Tue Jun 5 16:52:16 2018 Page 2
ID:9_xLMwZ3WdKc3QXh8cyzSnzB2V3-EDLzclqHqL_mlkq2Xf7tO81W9VWFB1xUTOOn3Jz9Hjz

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (H) (INPUT = 0.90)

JSI METAL= 0.51 (A) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



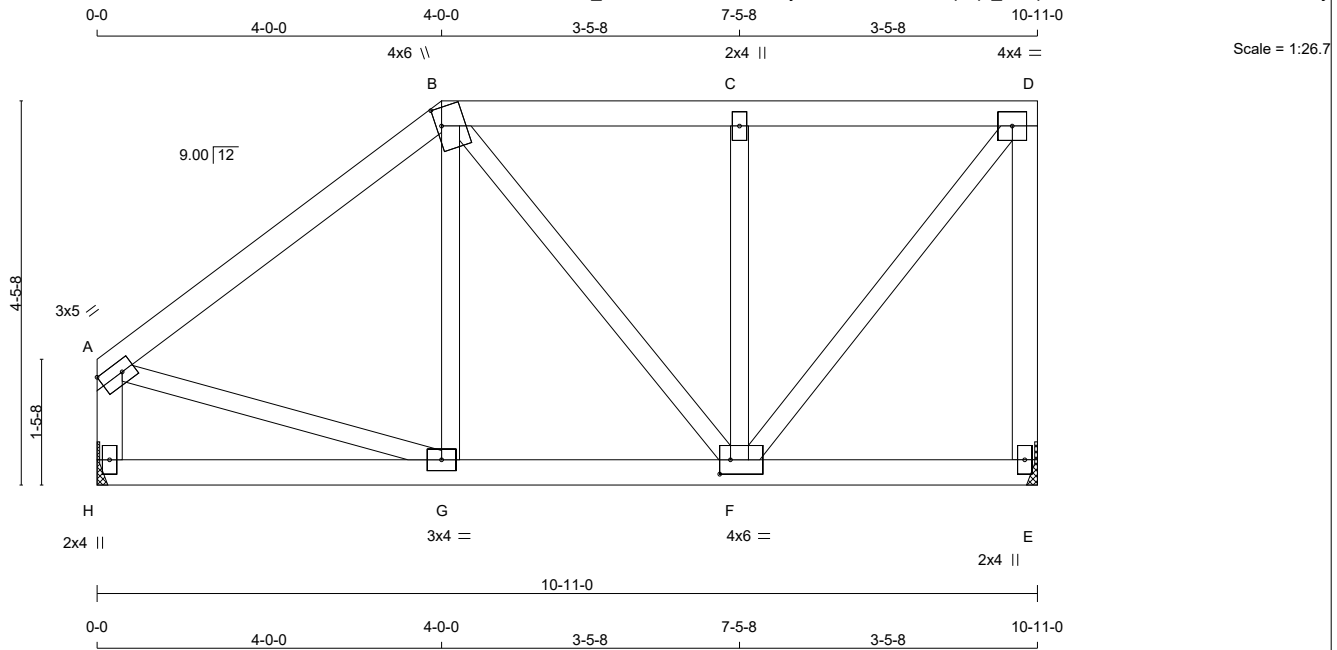

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF
B - D	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF
H - A	2x4	DRY	No.2	SPF
H - E	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	3.0	5.0	1.50	Edge
B	TTWW+m	MT20	4.0	6.0	2.50	0.75
C	TMW+w	MT20	2.0	4.0		
D	TMVW-t	MT20	4.0	4.0		
E	BMV1+p	MT20	2.0	4.0		
F	BMWWW-t	MT20	4.0	6.0	2.00	1.50
G	BMWW-t	MT20	3.0	4.0		
H	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES

- 1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 128.9 lbs FACTORED DOWN AT 4-0-0 ON TOP CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ UPLIFT		
E	748	0	748	0	0	MECHANICAL
H	707	0	707	0	0	MECHANICAL

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT E, H TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	525	367 / 0	0 / 0	0 / 0	0 / 0	158 / 0	0 / 0
H	497	343 / 0	0 / 0	0 / 0	0 / 0	155 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)		
FR-TO		FROM TO			FR-TO				
A-B	-619 / 0	-77.4 -77.4	0.24 (1)	6.25	G-B	-28 / 79	0.03 (4)		
B-C	-470 / 0	-107.2 -107.2	0.23 (1)	6.25	B-F	-36 / 0	0.02 (1)		
C-D	-470 / 0	-107.2 -107.2	0.23 (1)	6.25	F-C	-453 / 0	0.14 (1)		
E-D	-710 / 0	0.0 0.0	0.23 (1)	7.81	F-D	0 / 736	0.18 (1)		
H-A	-664 / 0	0.0 0.0	0.08 (1)	7.81	A-G	0 / 513	0.13 (1)		
H-G	0 / 0	-25.3 -25.3	0.10 (4)	10.00					
G-F	0 / 494	-25.3 -25.3	0.14 (1)	10.00					
F-E	0 / 0	-25.3 -25.3	0.07 (4)	10.00					

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
B	4-0-0	-129	-129	---	BACK	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	PSF
DL	=	3.0	PSF
BOT CH.	LL	=	PSF
DL	=	7.3	PSF
TOTAL LOAD	=	33.6	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

GIRDER TYPE: CPrimeHip

LEFT SETBACK = 4-0-0
RIGHT SETBACK = 0-0
END WALL WIDTH = 5-8
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO BACK SIDE
- ADDTL LOADS BASED ON 55 % OF GSL.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.36")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.36")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.24/1.00 (A-B:1), BC=0.14/1.00 (F-G:1), WB=0.18/1.00 (D-F:1), SSI=0.20/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

CONTINUED ON PAGE 2

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN YORK HOMES - GRANELLI HOME CORP - INDIGO 1 ELEV 1	DRWG NO.
NE0618-034	G10	1	1	TRUSS DESC.		PAGE 24 OF 61

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Tue Jun 5 16:52:16 2018 Page 2
ID:9 xLMwZ3WDKc3QXh8cyzSnzB2V3-EDLzclqHqL_mlkq2Xf7tO81aJVhFB6QUTOOn3Jz9Hjz

PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.82 (A) (INPUT = 0.90)
JSI METAL= 0.21 (A) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.




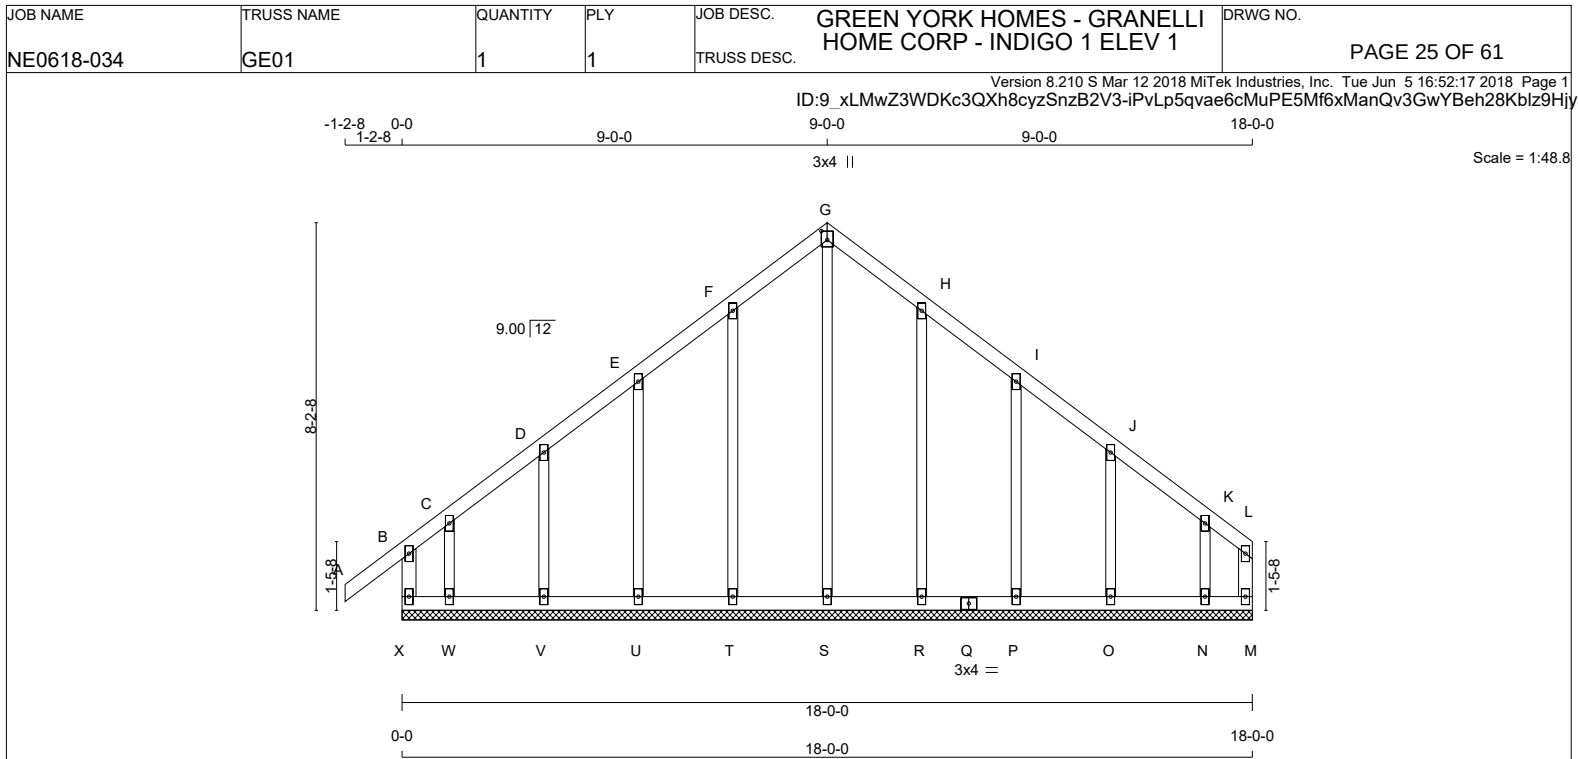

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER X - B 2x4 DRY No.2 A - G 2x4 DRY No.2 G - L 2x4 DRY No.2 M - L 2x4 DRY No.2 X - Q 2x4 DRY No.2 Q - M 2x4 DRY No.2 ALL WEBS 2x3 DRY No.2 ALL GABLE WEBS 2x3 DRY No.2 DRY: SEASONED LUMBER. GABLE STUDS SPACED AT 2-0-0 OC.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS. THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE. BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4)				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 23.3 PSF DL = 3.0 PSF BOT CH. LL = 0.0 PSF DL = 7.3 PSF TOTAL LOAD = 33.6 PSF SPACING = 24.0 IN. C/C THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010 THIS DESIGN COMPLIES WITH: - PART 9 OF OBC 2012, BCBC 2012, ABC 2014 - CSA 086-09 - TPIC 2011 DESIGN ASSUMPTIONS - OVERHANG NOT TO BE ALTERED OR CUT OFF. (55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD CSI: TC=0.09/1.00 (A-B:1), BC=0.03/1.00 (W-X:1), WB=0.21/1.00 (G-S:1), SSI=0.06/1.00 (A-B:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10 COMPANION LIVE LOAD FACTOR = 0.50 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT . NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 822 2284 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.51 (G) (INPUT = 0.90) JSI METAL= 0.06 (G) (INPUT = 1.00)			
PLATES (table is in inches) JT TYPE PLATES W LEN Y X B TMV+p MT20 2.0 4.0 C, D, E, F, H, I, J, K C TMW+w MT20 2.0 4.0 G TTW+p MT20 3.0 4.0 2.25 1.50 L TMV+p MT20 2.0 4.0 M BMV1+p MT20 2.0 4.0 N, O, P, R, S, T, U, V, W N BMW1+w MT20 2.0 4.0 Q BS-t MT20 3.0 4.0 X BMV1+p MT20 2.0 4.0				CHORDS MAX. FACTORED FORCE (LBS) FACTORED VERT. LOAD (PLF) MAX. FACTORED LC1 MAX. FACTORED CSI (LC) MEMB. FROM TO FR-TO X-B -189 / 0 0.0 0.0 0.02 (1) 7.81 A-B 0 / 30 -77.4 -77.4 0.09 (1) 10.00 B-C -38 / 0 -77.4 -77.4 0.08 (1) 6.25 C-D 0 / 0 -77.4 -77.4 0.04 (1) 10.00 D-E -2 / 0 -77.4 -77.4 0.04 (1) 10.00 E-F 0 / 4 -77.4 -77.4 0.04 (1) 10.00 F-G 0 / 5 -77.4 -77.4 0.04 (1) 10.00 G-H 0 / 5 -77.4 -77.4 0.04 (1) 10.00 H-I 0 / 4 -77.4 -77.4 0.04 (1) 10.00 I-J -1 / 0 -77.4 -77.4 0.04 (1) 10.00 J-K -3 / 0 -77.4 -77.4 0.04 (1) 10.00 K-L -5 / 0 -77.4 -77.4 0.02 (1) 10.00 M-L -30 / 0 0.0 0.0 0.01 (1) 7.81 X-W 0 / 7 -18.2 -18.2 0.03 (1) 10.00 W-V 0 / 5 -18.2 -18.2 0.02 (4) 10.00 V-U 0 / 0 -18.2 -18.2 0.02 (4) 10.00 U-T -2 / 0 -18.2 -18.2 0.01 (4) 10.00 T-S -4 / 0 -18.2 -18.2 0.01 (4) 10.00 S-R -4 / 0 -18.2 -18.2 0.01 (4) 10.00 R-Q -2 / 0 -18.2 -18.2 0.01 (4) 10.00 Q-P -2 / 0 -18.2 -18.2 0.01 (4) 10.00 P-O 0 / 0 -18.2 -18.2 0.02 (4) 10.00 O-N 0 / 5 -18.2 -18.2 0.02 (4) 10.00 N-M 0 / 10 -18.2 -18.2 0.01 (4) 10.00				WEBS MAX. FACTORED FORCE (LBS) MAX. FACTORED CSI (LC) MEMB. FROM TO FR-TO S-G -167 / 0 0.21 (1) T-F -158 / 0 0.12 (1) U-E -149 / 0 0.06 (1) V-D -162 / 0 0.04 (1) W-C -54 / 0 0.01 (1) R-H -158 / 0 0.12 (1) P-I -150 / 0 0.06 (1) O-J -158 / 0 0.03 (1) N-K -117 / 0 0.02 (1)			

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



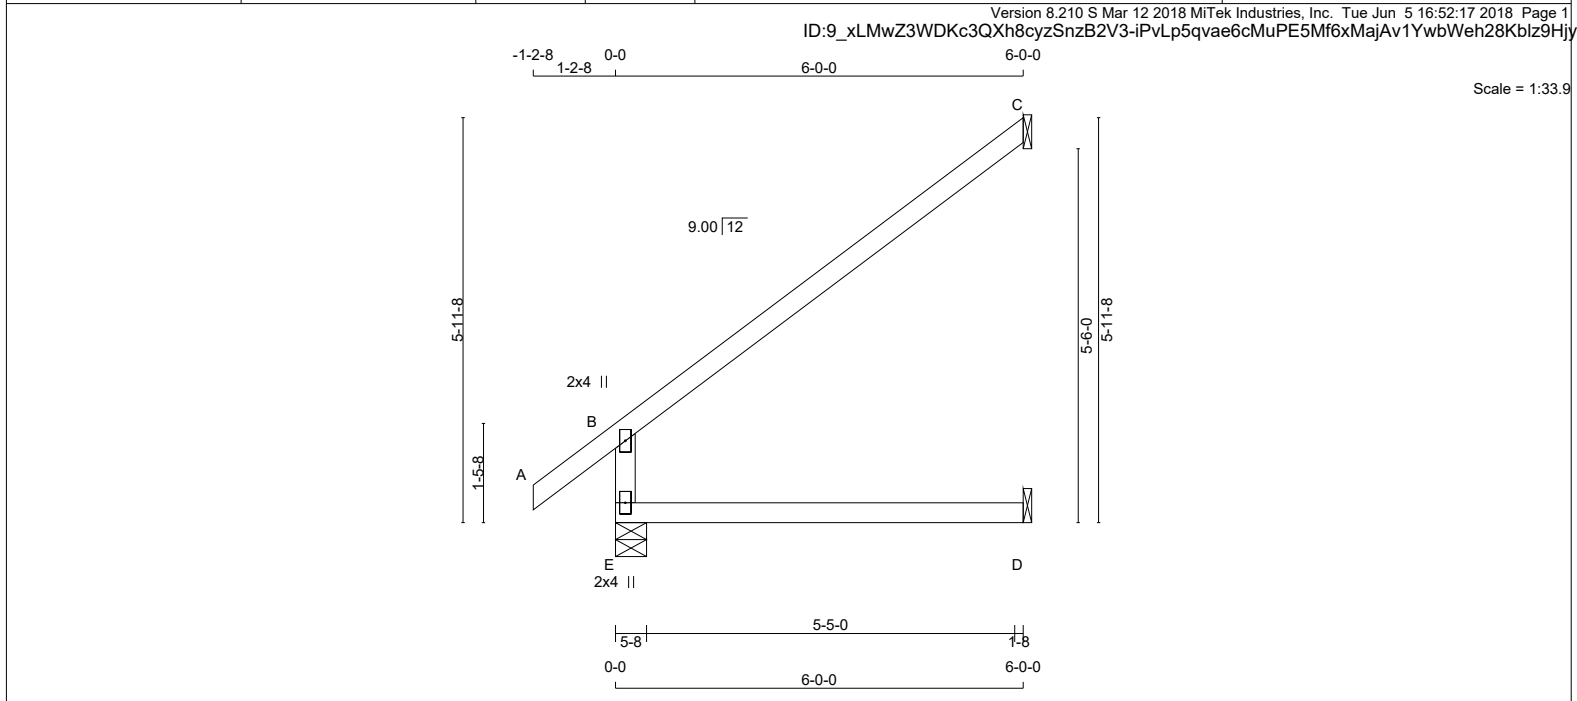

TOTAL WEIGHT = 10 X 19 = 185 lb [M][F]

LUMBER				DESCR.	
N. L. G. A. RULES				SPF	
CHORDS	SIZE	LUMBER		SPF	
E - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
JT	FACTORED GROSS REACTION	FACTORED GROSS REACTION	FACTORED GROSS REACTION	INPUT BRG	REQD BRG				
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
E	454	0	454	0	0	5-8	5-8		
C	174	0	174	0	0	1-8	1-8		
D	46	0	52	0	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS									
JT	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
E	316	235 / 0	0 / 0	0 / 0	0 / 0	81 / 0	0 / 0		
C	118	105 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0		
D	37	0 / 0	0 / 0	0 / 0	0 / 0	37 / 0	0 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)		
FR-TO		FROM	TO		FR-TO				
E-B	-390 / 0	0.0	0.0	0.11 (4)	7.81				
A-B	0 / 30	-77.4	-77.4	0.09 (1)	10.00				
B-C	-35 / 0	-77.4	-77.4	0.37 (1)	6.25				
E-D	0 / 0	-18.2	-18.2	0.14 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/999 (0.04")

CSI: TC=0.37/1.00 (B-C:1), BC=0.14/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.27 (B) (INPUT = 0.90)
JSI METAL= 0.10 (B) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



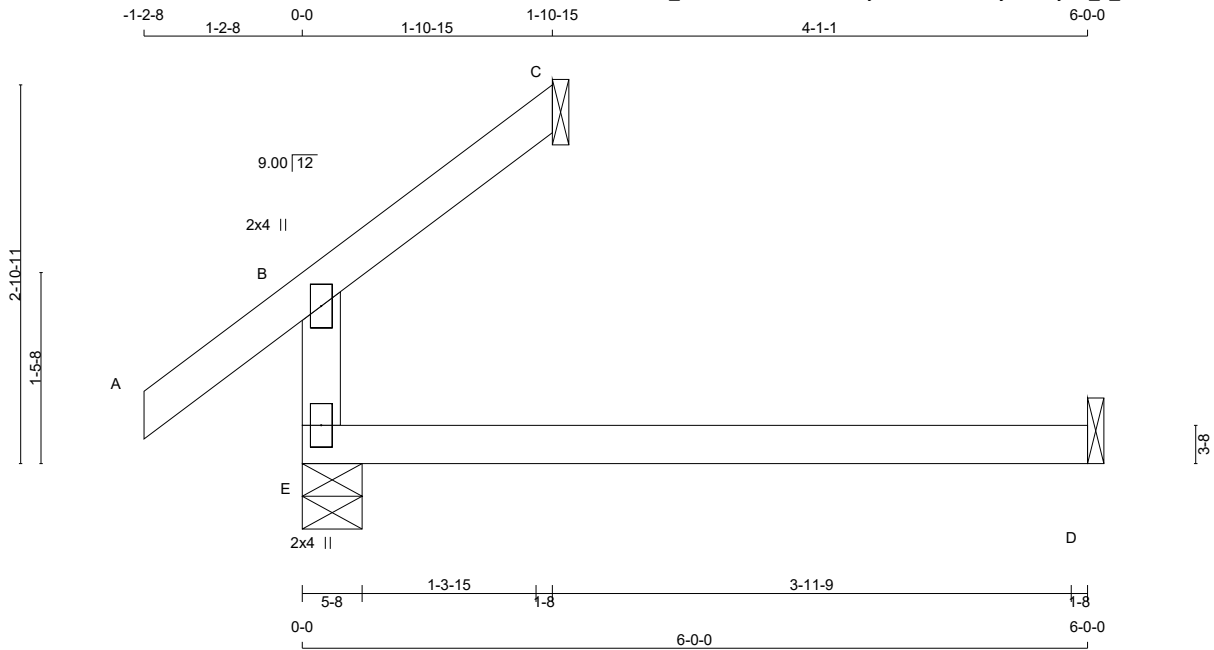

TOTAL WEIGHT = 2 X 13 = 25 lb [M][F]

LUMBER
N. L. G. A. RULES
CHORDS SIZE DRY LUMBER DESCR. SPF
E - B 2x4 DRY No.2 SPF
A - C 2x4 DRY No.2 SPF
E - D 2x4 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)
JT TYPE PLATES W LEN Y X
B TMV+p MT20 2.0 4.0
E BMV1+p MT20 2.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
E	256	0	256	0	0	5-8	5-8	
C	56	0	56	0	0	1-8	1-8	
D	46	0	52	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C , D

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
E	181	116 / 0	0 / 0	0 / 0	0 / 0	66 / 0	0 / 0
C	38	34 / 0	0 / 0	0 / 0	0 / 0	4 / 0	0 / 0
D	37	0 / 0	0 / 0	0 / 0	0 / 0	37 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (FT)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO		
E-B	-192 / 0	0.0 0.0 0.11 (4)	7.81	
A-B	0 / 30	-77.4 -77.4 0.09 (1)	10.00	
B-C	-11 / 0	-77.4 -77.4 0.04 (1)	6.25	
E-D	0 / 0	-18.2 -18.2 0.14 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.04")

CSI: TC=0.11/1.00 (B-E:4) , BC=0.14/1.00 (D-E:4) ,
WB=0.00/1.00 (n/a:0) , SSI=0.09/1.00 (D-E:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.13 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN YORK HOMES - GRANELLI HOME CORP - INDIGO 1 ELEV 1	DRWG NO.	PAGE 28 OF 61
NE0618-034	J03	2	1	TRUSS DESC.			

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Tue Jun 5 16:52:18 2018 Page 1
ID:9_xLMwZ3WDKc3QXh8cyzSnzB2V3-AcTj0RrXLYET_2_Rf4ALUZ6wDINnf2mnwitu7Bz9Hjx

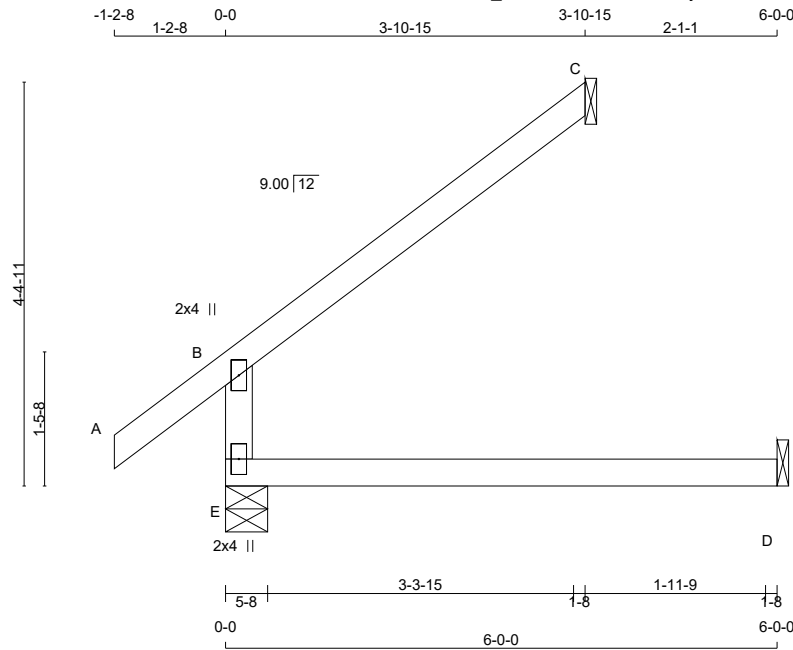

Scale = 1:25.1

TOTAL WEIGHT = 2 X 16 = 31 lb [M][F]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	SPF
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	2.0	4.0
E	BMV1+p	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
E	353	0	353	0	0	5-8	5-8	
C	114	0	114	0	0	1-8	1-8	
D	46	0	52	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C , D

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
E	247	174 / 0	0 / 0	0 / 0	0 / 0	73 / 0	0 / 0
C	77	68 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0
D	37	0 / 0	0 / 0	0 / 0	0 / 0	37 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)
FR-TO		FROM TO		FROM TO
E-B	-289 / 0	0.0 0.0 0.11 (4)	7.81	
A-B	0 / 30	-77.4 -77.4 0.09 (1)	10.00	
B-C	-23 / 0	-77.4 -77.4 0.15 (1)	6.25	
E-D	0 / 0	-18.2 -18.2 0.14 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.3	PSF
TOTAL LOAD	=	33.6	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.04")

CSI: TC=0.15/1.00 (B-C:1) , BC=0.14/1.00 (D-E:4) ,
WB=0.00/1.00 (n/a:0) , SSI=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.20 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



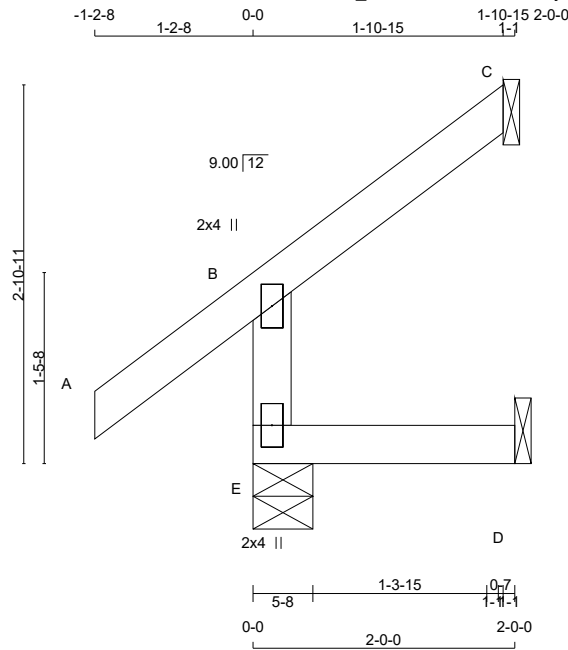

Scale = 1:17.6

TOTAL WEIGHT = 2 X 8 = 16 lb [M]

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
E	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
E	212	0	212	0	5-8	5-8
C	56	0	56	0	1-8	1-8
D	17	0	19	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	147	116 / 0	0 / 0	0 / 0	0 / 0	31 / 0	0 / 0
C	38	34 / 0	0 / 0	0 / 0	0 / 0	4 / 0	0 / 0
D	13	0 / 0	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS				WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	CS1 (LC)	MAX. MEMB. UNBRACED LENGTH	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)	FR-TO
E-B	-192 / 0	0.0	0.0	0.01 (4)	7.81			
A-B	0 / 30	-77.4	-77.4	0.09 (1)	10.00			
B-C	-11 / 0	-77.4	-77.4	0.05 (1)	6.25			
E-D	0 / 0	-18.2	-18.2	0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.3	PSF
TOTAL LOAD	=	33.6	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= L/999 (0.00")

CSI: TC=0.09/1.00 (A-B:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.06/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	822	2284	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.13 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



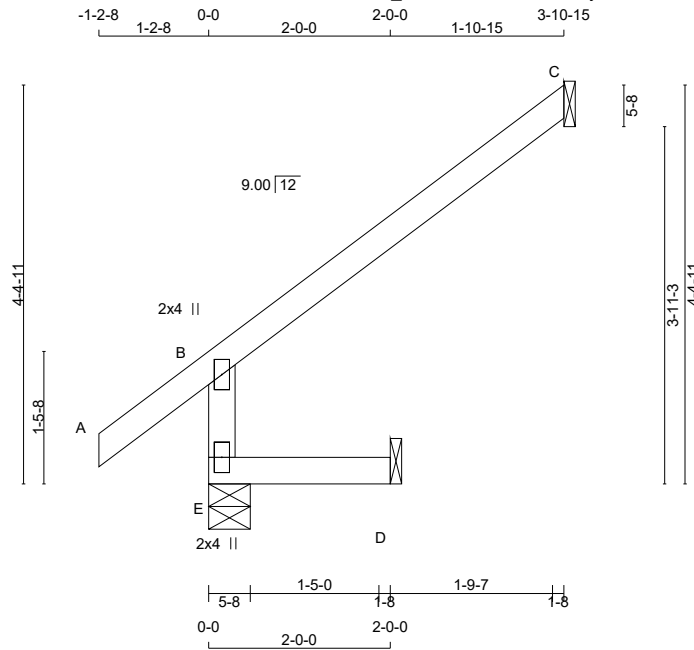

TOTAL WEIGHT = 2 X 11 = 22 lb [M]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	2.0	4.0
E	BMV1+p	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
E	309	0	309	0	5-8	5-8
C	114	0	114	0	1-8	1-8
D	17	0	19	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C , D

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
E	213	174 / 0	0 / 0	0 / 0	0 / 0	38 / 0	0 / 0
C	77	68 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0
D	13	0 / 0	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		WEBS		MEMB.	FACTORED	
	MAX. FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	MAX. UNBRAC LENGTH	FR-TO		MAX. FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO						
E-B	-289 / 0	0.0	0.0	0.01 (4)	7.81				
A-B	0 / 30	-77.4	-77.4	0.09 (1)	10.00				
B-C	-23 / 0	-77.4	-77.4	0.20 (1)	6.25				
E-D	0 / 0	-18.2	-18.2	0.02 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.3	PSF
TOTAL LOAD	=	33.6	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.00")

CSI: TC=0.20/1.00 (B-C:1) , BC=0.02/1.00 (D-E:4) ,
WB=0.00/1.00 (n/a:0) , SSI=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES				
PLATE	GRIP(DRY)	SHEAR	SECTION	
(PSI)	(PLI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	MAX MIN	
MT20	618	354	1667	822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.20 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



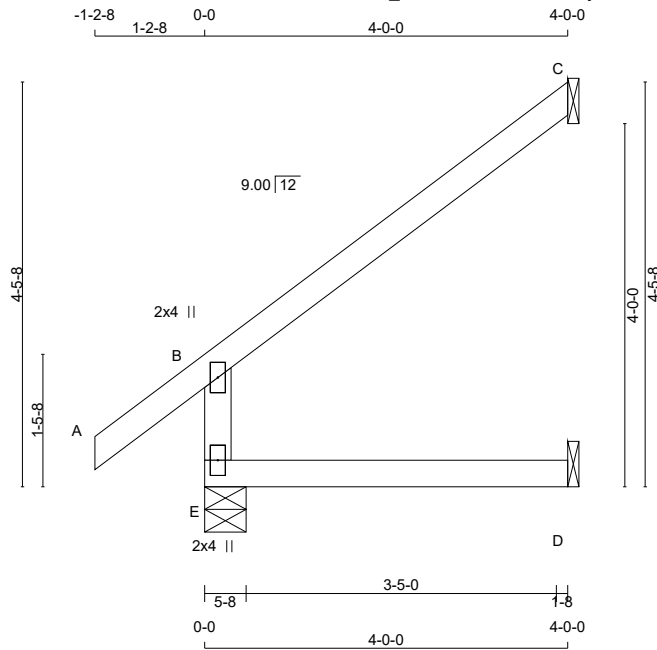

Scale = 1:25.4

TOTAL WEIGHT = 4 X 13 = 54 lb [M]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	2.0	4.0
E	BMV1+p	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQRD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	335	0	335	0	5-8	5-8
C	116	0	116	0	1-8	1-8
D	32	0	35	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C , D

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	SNOW	LIVE	PERM.	LIVE			
E	233	177 / 0	0 / 0	0 / 0	0 / 0	56 / 0	0 / 0
C	79	70 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0
D	25	0 / 0	0 / 0	0 / 0	0 / 0	25 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)		FACTORED VERT. LOAD (PLF)		MAX. UNBRACED LENGTH	WEBS MAX. FACTORED FORCE (LBS)	
	FROM	TO	LC1	LC2		FROM	TO
E-B	-294 / 0	0.0	0.0	0.05 (4)	7.81		
A-B	0 / 30	-77.4	-77.4	0.09 (1)	10.00		
B-C	-23 / 0	-77.4	-77.4	0.21 (1)	6.25		
E-D	0 / 0	-18.2	-18.2	0.06 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.3	PSF
TOTAL LOAD	=	33.6	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.01")

CSI: TC=0.21/1.00 (B-C:1) , BC=0.06/1.00 (D-E:4) ,
WB=0.00/1.00 (n/a:0) , SSI=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	822	2284	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.20 (B) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



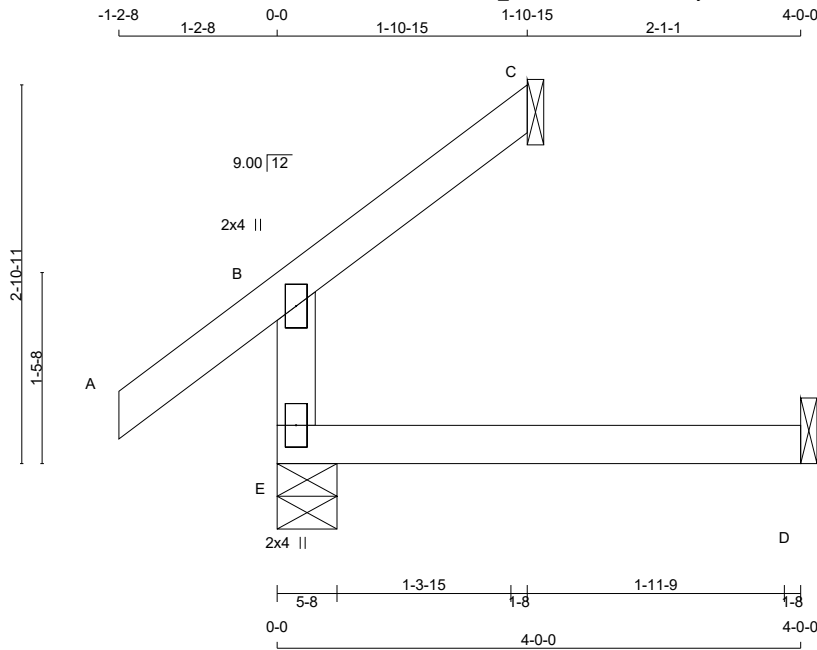

Scale = 1:17.6

TOTAL WEIGHT = 10 lb [M]

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
E	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQRD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	234	0	234	0	5-8	5-8
C	56	0	56	0	1-8	1-8
D	32	0	35	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C , D

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS				
		SNOW	LIVE	PERM. LIVE	WIND	DEAD
E	164	116 / 0	0 / 0	0 / 0	0 / 0	48 / 0
C	38	34 / 0	0 / 0	0 / 0	0 / 0	4 / 0
D	25	0 / 0	0 / 0	0 / 0	0 / 0	25 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

MEMB.	CHORDS				WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	CS1 (LC)	MAX. MEMB. UNBRACED LENGTH	MAX. FACTORED FORCE (LBS)	FACTORED CS1 (LC)	MAX
FR-TO		FROM	TO		FR-TO			
E-B	-192 / 0	0.0	0.0	0.05 (4)	7.81			
A-B	0 / 30	-77.4	-77.4	0.09 (1)	10.00			
B-C	-11 / 0	-77.4	-77.4	0.05 (1)	6.25			
E-D	0 / 0	-18.2	-18.2	0.06 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.01")

CSI: TC=0.09/1.00 (A-B:1) , BC=0.06/1.00 (D-E:4) , WB=0.00/1.00 (n/a:0) , SSI=0.06/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.13 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Tue Jun 5 16:52:20 2018 Page 1
ID:9_xLMwZ3WDKc3QXh8cyzSnzB2V3-7_aUR7totZUBEM7pmVCpZ_BIY6527yG4O0M_C4z9Hjv

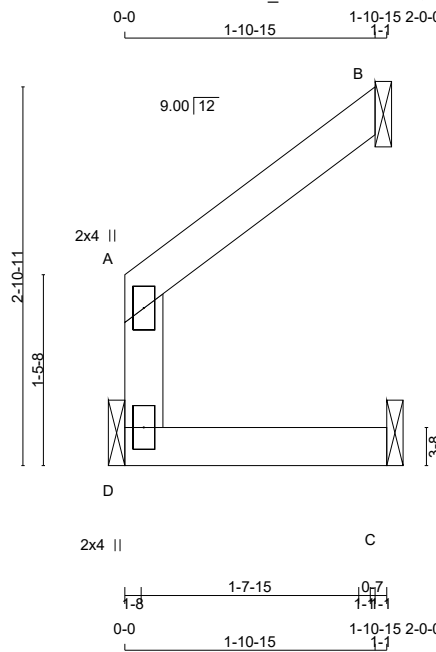

Scale = 1:17.6

TOTAL WEIGHT = 6 lb
[M][F]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	SPF
D - A	2x4	DRY	No.2	SPF
A - B	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMV+p	MT20	2.0	4.0
D	BMV1+p	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG
D	92	0	0	92	0	0	1-8	1-8	1-8
B	70	0	0	70	0	0	1-8	1-8	1-8
C	22	0	0	22	0	0	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) D , B , C

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
D	65	45/0	0/0	0/0	0/0	20/0	0/0
B	47	41/0	0/0	0/0	0/0	6/0	0/0
C	17	3/0	0/0	0/0	0/0	14/0	0/0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	FORCE (LBS)	MEMB.	FORCE (LBS)
FR-TO		FR-TO	
D-A	-78/0	D-A	-78/0
A-B	-3/0	A-B	-3/0
D-C	0/0	D-C	0/0

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= L/999 (0.00")

CSI: TC=0.04/1.00 (A-B:1) , BC=0.02/1.00 (C-D:4) , WB=0.00/1.00 (n/a:0) , SSI=0.05/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.05 (A) (INPUT = 0.90)
JSI METAL= 0.02 (A) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



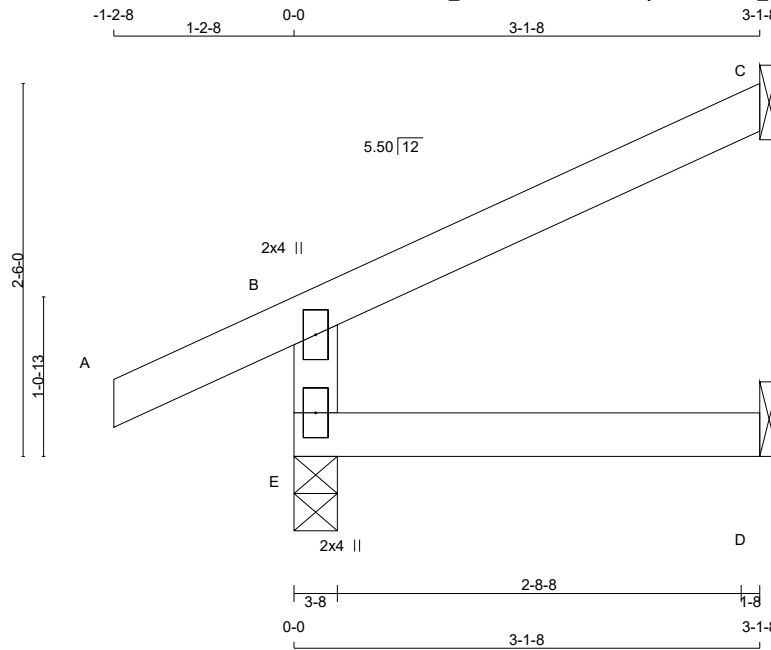

Scale = 1:15.5

TOTAL WEIGHT = 4 X 10 = 39 lb [M]

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
E	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
E	282	0	282	0	3-8	3-8
C	91	0	91	0	1-8	1-8
D	24	0	27	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS				
		COMBINED	SNOW	LIVE	PERM. LIVE	WIND
E	195	150 / 0	0 / 0	0 / 0	0 / 0	45 / 0
C	62	55 / 0	0 / 0	0 / 0	0 / 0	7 / 0
D	20	0 / 0	0 / 0	0 / 0	0 / 0	20 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS					WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	MAX. MEMB. UNBRAC LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO			FR-TO		
E-B	-249 / 0	0.0	0.0	0.03 (4)	7.81			
A-B	0 / 20	-77.4	-77.4	0.09 (1)	10.00			
B-C	-13 / 0	-77.4	-77.4	0.13 (1)	6.25			
E-D	0 / 0	-18.2	-18.2	0.04 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.00")

CSI: TC=0.13/1.00 (B-C:1), BC=0.04/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



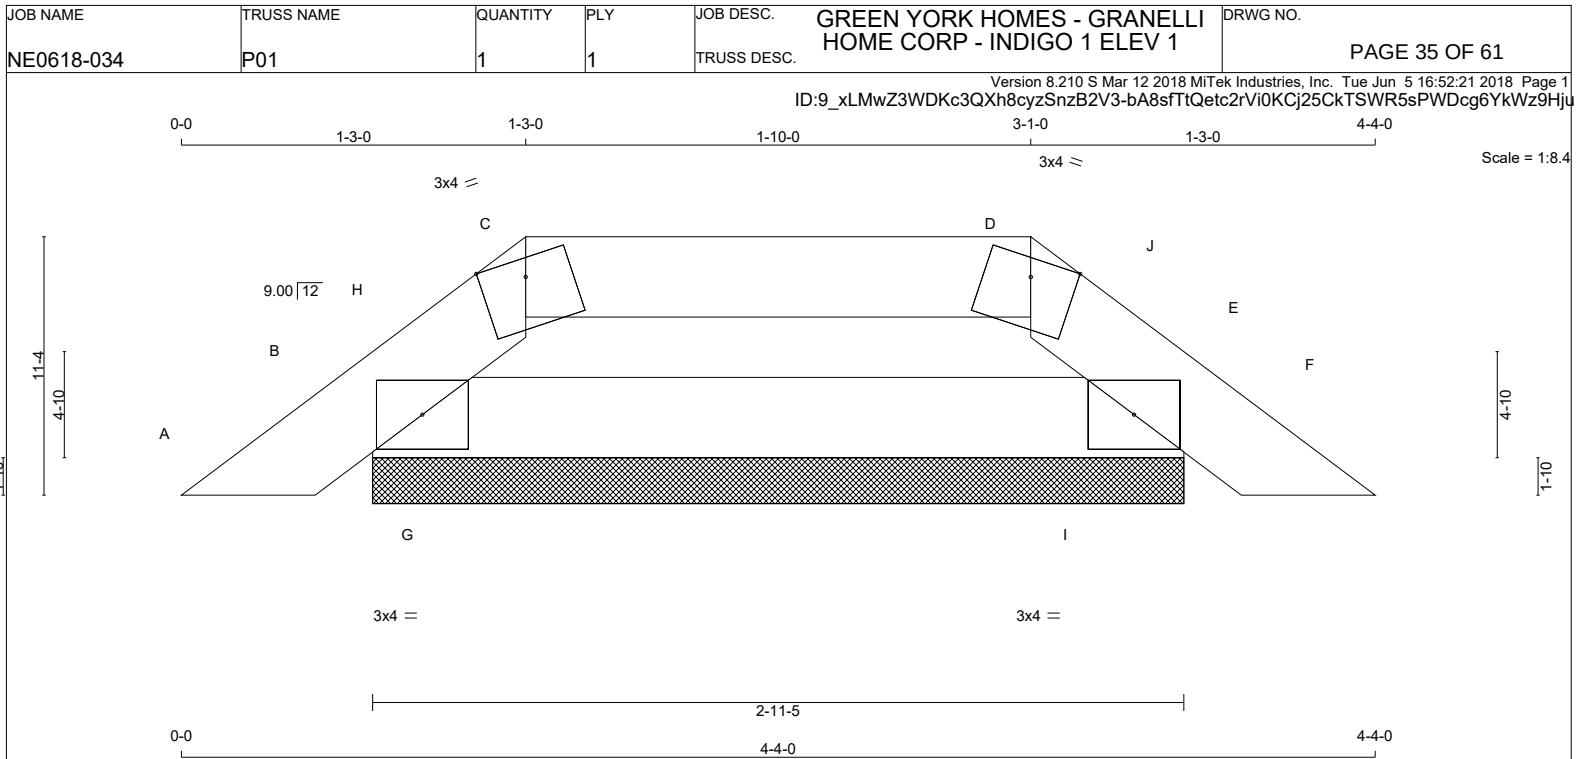

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
B - E	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0		
C	TT-m	MT20	3.0	4.0	Edge	
D	TT-m	MT20	3.0	4.0	Edge	
E	TMB1-I	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
B	188	0	188	0	2-11-5	2-11-5
E	188	0	188	0	2-11-5	2-11-5

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
B	131	97/0	0/0	0/0	0/0	34/0	0/0
E	131	97/0	0/0	0/0	0/0	34/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LC1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LC1 (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0/13	-77.4	-77.4 0.02 (1)	10.00	G-H	-39/22	0.00 (1)
B-H	-68/0	-77.4	-77.4 0.01 (4)	6.25	I-J	-39/22	0.00 (1)
H-C	-150/0	-77.4	-77.4 0.02 (1)	6.25			
C-D	-127/0	-77.4	-77.4 0.03 (1)	6.25			
D-J	-150/0	-77.4	-77.4 0.02 (1)	6.25			
J-E	-68/0	-77.4	-77.4 0.01 (4)	6.25			
E-F	0/13	-77.4	-77.4 0.02 (1)	10.00			
B-G	0/32	-18.2	-18.2 0.02 (1)	10.00			
G-I	0/127	-18.2	-18.2 0.03 (1)	10.00			
I-E	0/32	-18.2	-18.2 0.02 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.03/1.00 (C-D:1), BC=0.03/1.00 (G-I:1), WB=0.00/1.00 (G-H:1), SSI=0.06/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.13 (E) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



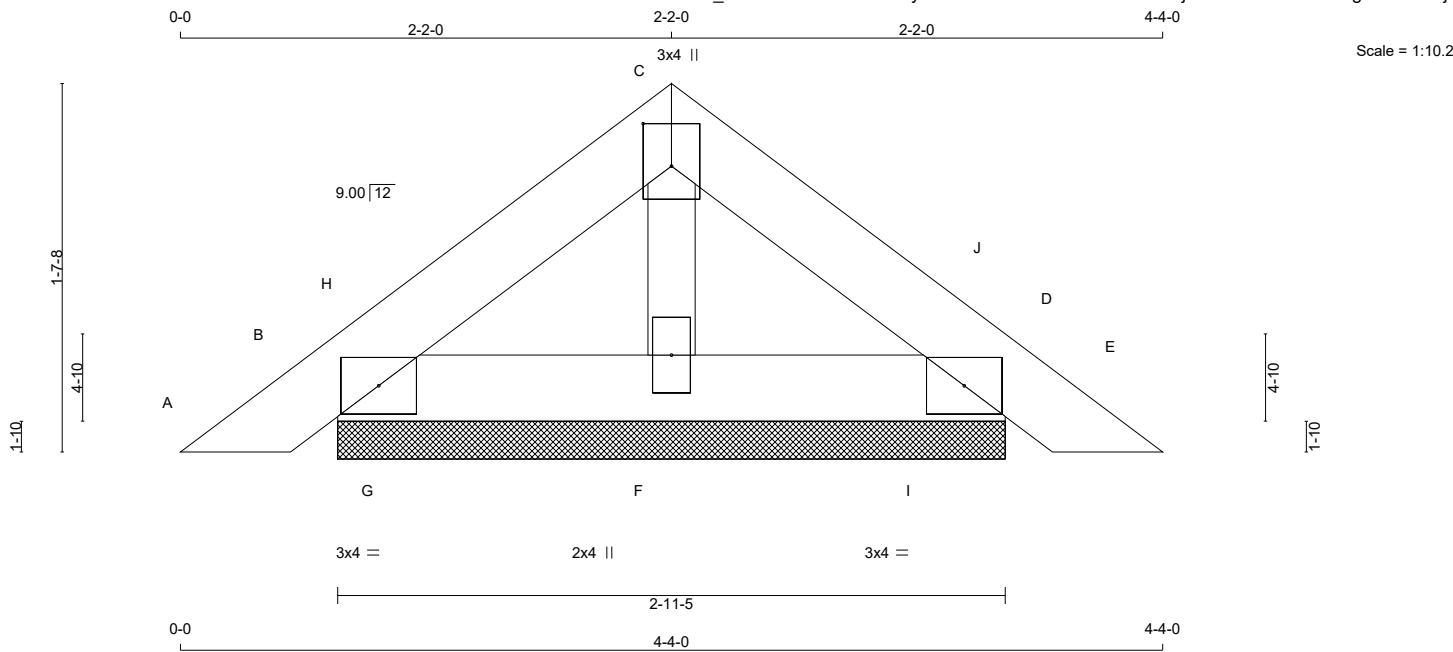

TOTAL WEIGHT = 6 X 10 = 61 lb [M]

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
B - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0		
C	TTW+p	MT20	3.0	4.0	2.25	1.50
D	TMB1-I	MT20	3.0	4.0		
F	BMW1+w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
B	127	0	127	0	2-11-5	2-11-5
D	127	0	127	0	2-11-5	2-11-5
F	121	0	121	0	2-11-5	2-11-5

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS				
		SNOW	LIVE	PERM.LIVE	WIND	DEAD
B	88	70 / 0	0 / 0	0 / 0	0 / 0	18 / 0
D	88	70 / 0	0 / 0	0 / 0	0 / 0	18 / 0
F	86	55 / 0	0 / 0	0 / 0	0 / 0	31 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)		
FR-TO		FROM	TO		FR-TO				
A-B	0 / 13	-77.4	-77.4	0.02 (1)	10.00	F-C	-54 / 0	0.01 (1)	
B-H	-27 / 0	-77.4	-77.4	0.00 (1)	6.25	G-H	-62 / 0	0.00 (1)	
H-C	-31 / 0	-77.4	-77.4	0.02 (1)	6.25	I-J	-62 / 0	0.00 (1)	
C-J	-31 / 0	-77.4	-77.4	0.02 (1)	6.25				
J-D	-27 / 0	-77.4	-77.4	0.00 (1)	6.25				
D-E	0 / 13	-77.4	-77.4	0.02 (1)	10.00				
B-G	0 / 24	-18.2	-18.2	0.02 (1)	10.00				
G-F	0 / 24	-18.2	-18.2	0.02 (1)	10.00				
F-I	0 / 24	-18.2	-18.2	0.02 (1)	10.00				
I-D	0 / 24	-18.2	-18.2	0.02 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.02/1.00 (D-E:1), BC=0.02/1.00 (B-G:1), WB=0.01/1.00 (C-F:1), SSI=0.04/1.00 (D-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (D) (INPUT = 0.90)
JSI METAL= 0.02 (B) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



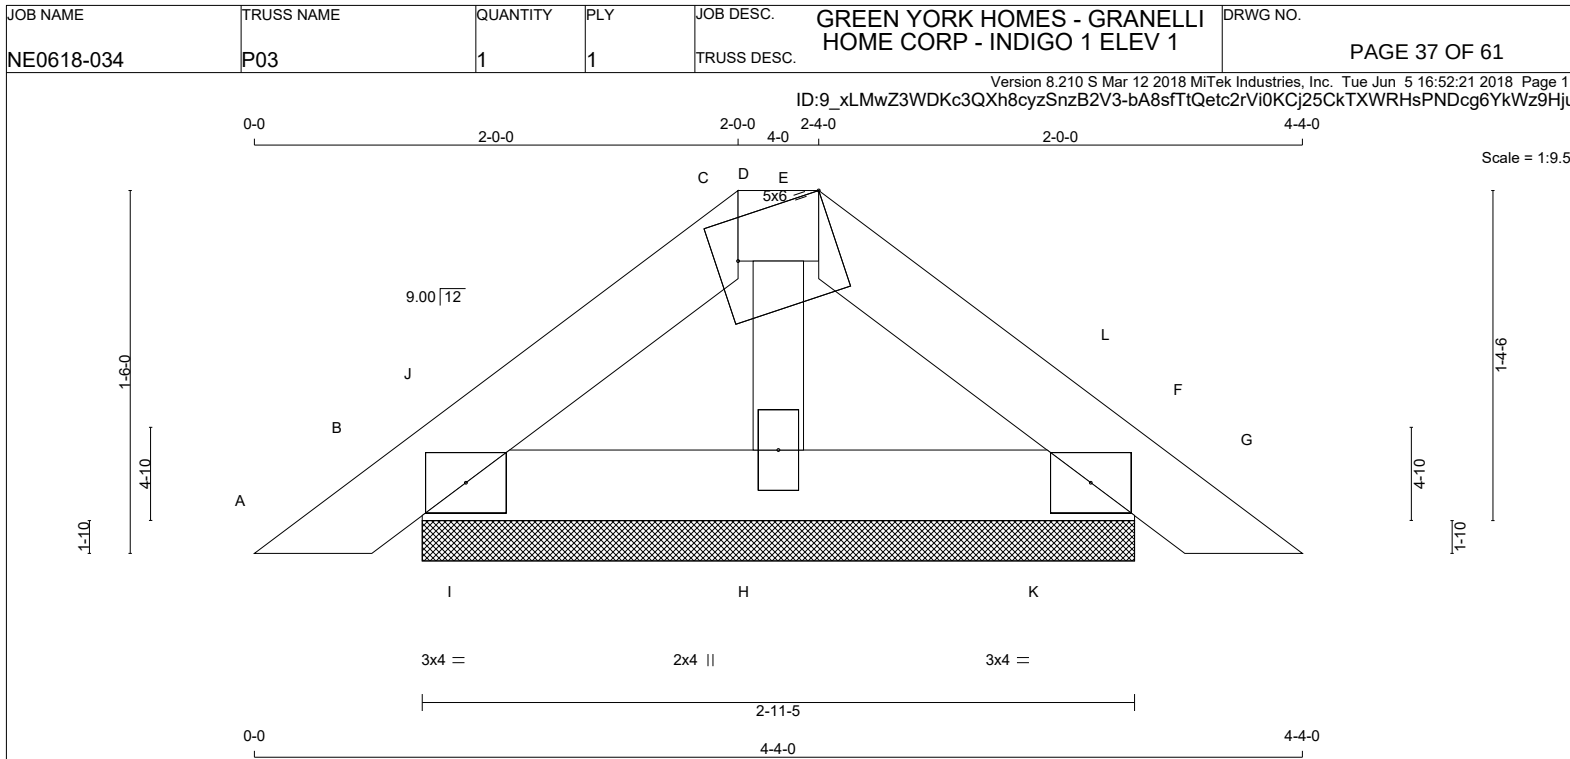

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
B - F	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0		
C, D, E						
C	TTTW*-m	MT20	5.0	6.0	Edge	5.00
F	TMB1-I	MT20	3.0	4.0		
H	BMW1+w	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
B	125	0	125	0	2-11-5	2-11-5
F	125	0	125	0	2-11-5	2-11-5
H	126	0	126	0	2-11-5	2-11-5

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS				
		SNOW	LIVE	PERM.LIVE	WIND	DEAD
B	86	68 / 0	0 / 0	0 / 0	0 / 0	18 / 0
F	86	68 / 0	0 / 0	0 / 0	0 / 0	18 / 0
H	89	57 / 0	0 / 0	0 / 0	0 / 0	32 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, F, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MAX. FACTORED		FACTORED			MAX. FACTORED		FACTORED		
MEMB.	FORCE	VERT. LOAD	LC1 MAX	MAX	MEMB.	FORCE	MAX		
	(LBS)	(PLF)	CSI (LC)			(LBS)	CSI (LC)		
FR-TO		FROM	TO	UNBRACED LENGTH	FR-TO				
A-B	0 / 13	-77.4	-77.4	0.02 (1)	10.00	H-D	-67 / 0	0.01 (1)	
B-J	-34 / 0	-77.4	-77.4	0.00 (4)	6.25	I-J	-47 / 2	0.00 (1)	
J-C	-32 / 0	-77.4	-77.4	0.01 (1)	6.25	K-L	-47 / 2	0.00 (1)	
C-D	-22 / 0	-77.4	-77.4	0.01 (1)	6.25				
D-E	-22 / 0	-77.4	-77.4	0.01 (1)	6.25				
E-L	-32 / 0	-77.4	-77.4	0.01 (1)	6.25				
L-F	-34 / 0	-77.4	-77.4	0.00 (4)	6.25				
F-G	0 / 13	-77.4	-77.4	0.02 (1)	10.00				
B-I	0 / 25	-18.2	-18.2	0.02 (1)	10.00				
I-H	0 / 25	-18.2	-18.2	0.02 (1)	10.00				
H-K	0 / 25	-18.2	-18.2	0.02 (1)	10.00				
K-F	0 / 25	-18.2	-18.2	0.02 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.02/1.00 (F-G:1), BC=0.02/1.00 (H-K:1), WB=0.01/1.00 (D-H:1), SSI=0.03/1.00 (F-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.09 (F) (INPUT = 0.90)
JSI METAL= 0.02 (F) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



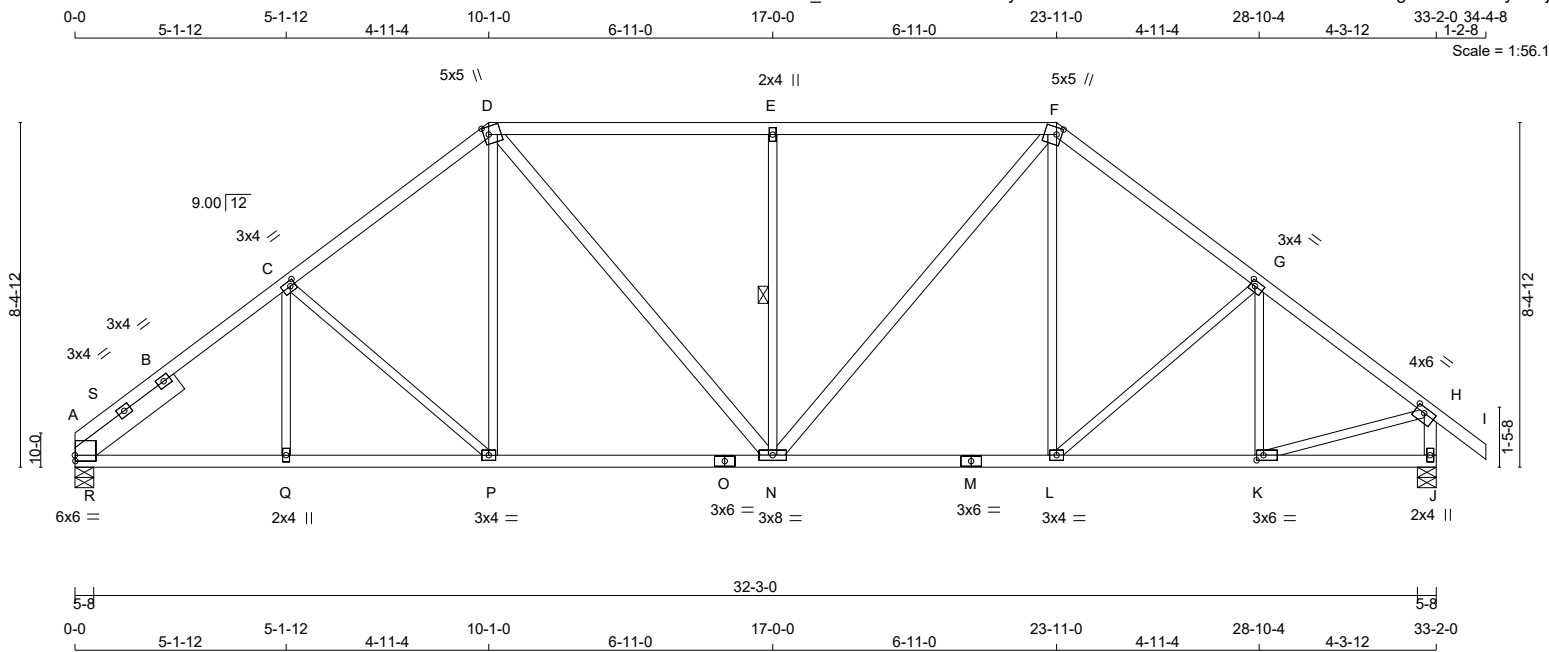

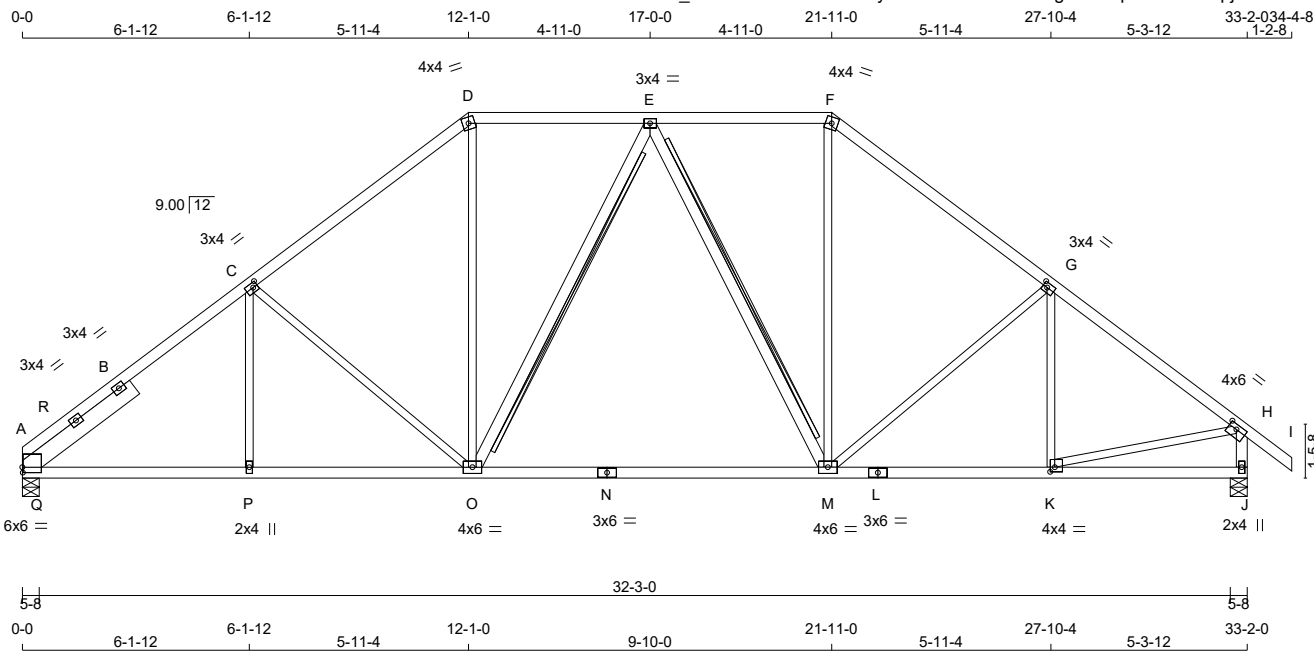

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
A - N	2x4	DRY	No.2	SPF
N - L	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF

REINFORCING MEMBERS

MEMBER	SIZE	DRY	LUMBER	DESCR.
HW1	2x6	DRY	No.2	SPF

ALL WEBS EXCEPT

MEMBER	SIZE	DRY	LUMBER	DESCR.
O - E	2x4	DRY	No.2	SPF
E - M	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMBMR1-I	MT20	6.0	6.0	1.75	0.25
A	RT-t	MT20	3.0	4.0		
A	RT-t	MT20	3.0	4.0		
C	TMWW-t	MT20	3.0	4.0	1.50	1.50
D	TTW-m	MT20	4.0	4.0		
E	TMWW-t	MT20	3.0	4.0		
F	TTW-m	MT20	4.0	4.0		
G	TMWW-t	MT20	3.0	4.0	1.50	1.50
H	TMVW-t	MT20	4.0	6.0	1.50	2.75
J	BMV1+p	MT20	2.0	4.0		
K	BMWW-t	MT20	4.0	4.0	1.50	1.50
L	BS-t	MT20	3.0	6.0		
M	BMWWW-t	MT20	4.0	6.0		
N	BS-t	MT20	3.0	6.0		
O	BMWWW-t	MT20	4.0	6.0		
P	BMW-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
A	1586	0	1586	0	5-8	5-8
J	1686	0	1686	0	5-8	5-8

UNFACTORED REACTIONS

	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
A	1114	772 / 0	0 / 0	0 / 0	0 / 0	342 / 0	0 / 0
J	1182	833 / 0	0 / 0	0 / 0	0 / 0	349 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.64 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT E-O, E-M

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	MEMB.
FR-TO		FROM TO		FR-TO			
A-R	-2016 / 0	-77.4 -77.4	0.05 (1)	4.75	P-C	0 / 95	0.03 (4)
R-B	-1510 / 0	-77.4 -77.4	0.31 (1)	5.04	C-O	-410 / 0	0.53 (1)
B-C	-1510 / 0	-77.4 -77.4	0.31 (1)	5.04	O-D	0 / 617	0.14 (1)
C-D	-1622 / 0	-77.4 -77.4	0.42 (1)	4.77	O-E	-212 / 0	0.18 (1)
D-E	-1286 / 0	-77.4 -77.4	0.25 (1)	5.41	E-M	-303 / 0	0.25 (1)
E-F	-1245 / 0	-77.4 -77.4	0.25 (1)	5.48	M-F	0 / 603	0.14 (1)
F-G	-1581 / 0	-77.4 -77.4	0.39 (1)	4.85	M-G	-272 / 0	0.35 (1)
G-H	-1775 / 0	-77.4 -77.4	0.37 (1)	4.64	K-G	-213 / 18	0.09 (1)
H-I	0 / 30	-77.4 -77.4	0.09 (1)	10.00	K-H	0 / 1479	0.33 (1)
I-J	-1643 / 0	0.0 0.0	0.17 (1)	6.46	Q-R	0 / 1099	0.00 (1)
A-Q	0 / 882	-18.2 -18.2	0.27 (1)	10.00	Q-B	-1055 / 0	0.12 (1)
Q-P	0 / 1592	-18.2 -18.2	0.39 (1)	10.00			
P-O	0 / 1592	-18.2 -18.2	0.42 (1)	10.00			
O-N	0 / 1381	-18.2 -18.2	0.39 (1)	10.00			
N-M	0 / 1381	-18.2 -18.2	0.39 (1)	10.00			
M-L	0 / 1447	-18.2 -18.2	0.39 (1)	10.00			
L-K	0 / 1447	-18.2 -18.2	0.39 (1)	10.00			
K-J	0 / 0	-18.2 -18.2	0.11 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.1")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL)= L/360 (1.1")
CALCULATED VERT. DEFL.(TL) = L/999 (0.25")

CSI: TC=0.42/1.00 (C-D:1), BC=0.42/1.00 (O-P:1), WB=0.53/1.00 (C-O:1), SSI=0.23/1.00 (A-Q:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (K) (INPUT = 0.90)
JSI METAL= 0.54 (K) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



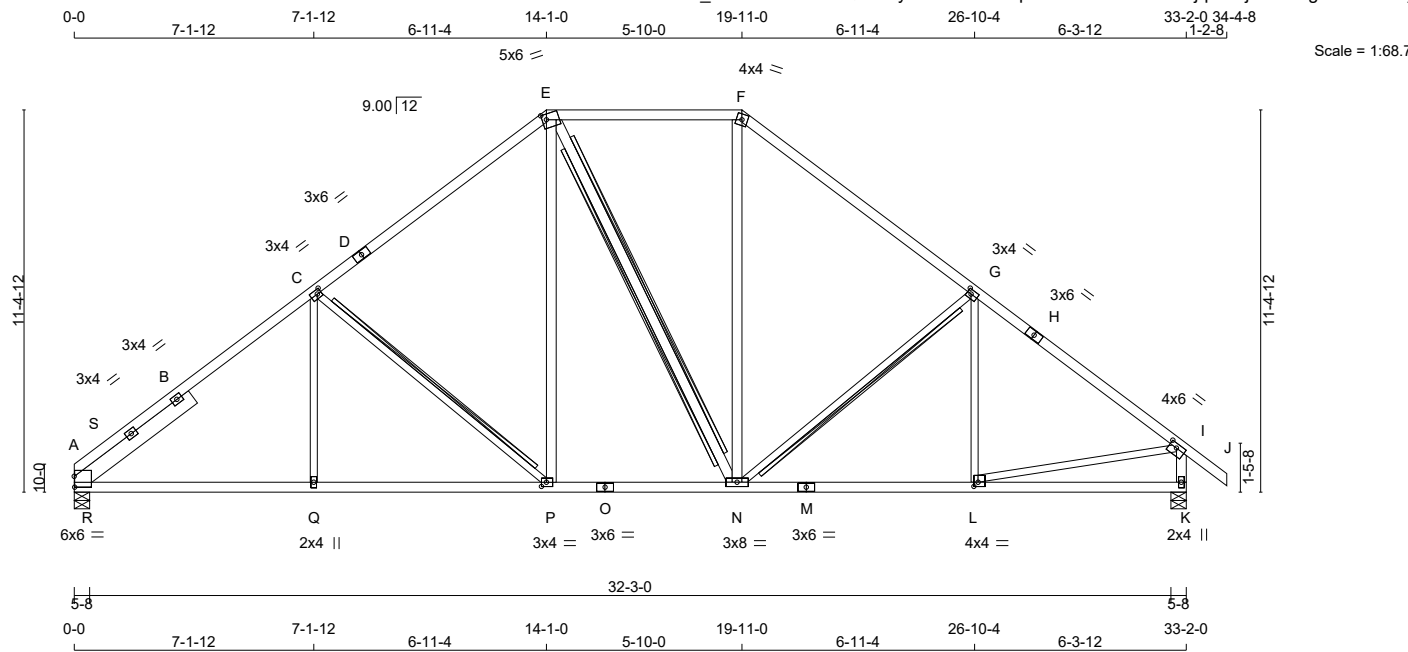

TOTAL WEIGHT = 161 lb
[M][F]

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - E	2x4	DRY No.2	SPF
E - F	2x4	DRY No.2	SPF
F - H	2x4	DRY No.2	SPF
H - J	2x4	DRY No.2	SPF
K - I	2x4	DRY No.2	SPF
A - O	2x4	DRY No.2	SPF
O - M	2x4	DRY No.2	SPF
M - K	2x4	DRY No.2	SPF
REINFORCING MEMBERS			
HW1	2x6	DRY No.2	SPF
ALL WEBS EXCEPT			
P - E	2x4	DRY No.2	SPF
E - N	2x4	DRY No.2	SPF
N - F	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMBMR1-I	MT20	6.0	6.0 4.00 0.25
A	RT-t	MT20	3.0	4.0
A	RT-t	MT20	3.0	4.0
C	TMWW-t	MT20	3.0	4.0 1.50 1.50
D	TS-t	MT20	3.0	6.0
E	TTWW-m	MT20	5.0	6.0 2.00 1.50
F	TTWW-m	MT20	4.0	4.0
G	TMWW-t	MT20	3.0	4.0 1.50 1.50
H	TS-t	MT20	3.0	6.0
I	TMVV-t	MT20	4.0	6.0 1.50 2.75
K	BMV1+p	MT20	2.0	4.0
L	BMWW-t	MT20	4.0	4.0 1.50 1.50
M	BS-t	MT20	3.0	6.0
N	BMWWW-t	MT20	3.0	8.0
O	BS-t	MT20	3.0	6.0
P	BMWW-t	MT20	3.0	4.0 1.50 1.75
Q	BMW-w	MT20	2.0	4.0

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	UP	BRG	IN-SX	IN-SX
A	1586	0	1586	0	0	5-8	5-8	5-8	5-8
K	1686	0	1686	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
A	1114	772 / 0	0 / 0	0 / 0	0 / 0	342 / 0	0 / 0		
K	1182	833 / 0	0 / 0	0 / 0	0 / 0	349 / 0	0 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.43 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT C-P, G-N
2x4 DRY SPF No.2 I-BRACE AT E-N

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX UNBRACED LENGTH	MAX. FACTORED CSI (LC)
FR-TO		FROM	TO	FR-TO			
A-S	-1947 / 0	-77.4	-77.4 0.07 (1)	4.80	Q-C	0 / 144	0.05 (4)
S-B	-1509 / 0	-77.4	-77.4 0.45 (1)	4.89	C-P	-549 / 0	0.37 (1)
B-C	-1509 / 0	-77.4	-77.4 0.45 (1)	4.89	P-E	0 / 465	0.07 (1)
C-D	-1478 / 0	-77.4	-77.4 0.54 (1)	4.77	E-N	-45 / 0	0.04 (1)
D-E	-1478 / 0	-77.4	-77.4 0.54 (1)	4.77	N-F	0 / 423	0.07 (1)
E-F	-1145 / 0	-77.4	-77.4 0.36 (1)	5.51	N-G	-424 / 0	0.28 (1)
F-G	-1462 / 0	-77.4	-77.4 0.55 (1)	4.78	L-G	-126 / 77	0.08 (1)
G-H	-1792 / 0	-77.4	-77.4 0.53 (1)	4.43	L-I	0 / 1489	0.34 (1)
H-I	-1792 / 0	-77.4	-77.4 0.53 (1)	4.43	R-S	0 / 947	0.00 (1)
I-J	0 / 30	-77.4	-77.4 0.09 (1)	10.00	R-B	-995 / 0	0.14 (1)
K-L	-1640 / 0	0.0	0.0 0.17 (1)	6.47			
A-R	0 / 891	-18.2	-18.2 0.24 (4)	10.00			
R-Q	0 / 1582	-18.2	-18.2 0.34 (1)	10.00			
Q-P	0 / 1582	-18.2	-18.2 0.34 (1)	10.00			
P-O	0 / 1165	-18.2	-18.2 0.27 (1)	10.00			
O-N	0 / 1165	-18.2	-18.2 0.27 (1)	10.00			
N-M	0 / 1465	-18.2	-18.2 0.34 (1)	10.00			
M-L	0 / 1465	-18.2	-18.2 0.34 (1)	10.00			
L-K	0 / 0	-18.2	-18.2 0.20 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
DL =	3.0	PSF	
BOT CH.	LL =	0.0	PSF
DL =	7.3	PSF	
TOTAL LOAD =	33.6	PSF	

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.11")
CALCULATED VERT. DEFL.(LL)= L/999 (0.07")
ALLOWABLE DEFL.(TL)= L/360 (1.11")
CALCULATED VERT. DEFL.(TL)= L/999 (0.16")

CSI: TC=0.55/1.00 (F-G:1), BC=0.34/1.00 (Q-R:1), WB=0.37/1.00 (C-P:1), SSI=0.24/1.00 (A-R:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.88 (P) (INPUT = 0.90)
JSI METAL= 0.55 (L) (INPUT = 1.00)

CONTINUED ON PAGE 2



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
NE0618-034	T04	1	1	GREEN YORK HOMES - GRANELLI HOME CORP - INDIGO 1 ELEV 1	PAGE 41 OF 61

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Tue Jun 5 16:52:25 2018 Page 1
ID:9_xLMwZ3WDKc3QXh8cyzSznB2V3-TyONUqxwi67UK70nZ2o_G2v1v7j0o7EpXl4tH9Hjg

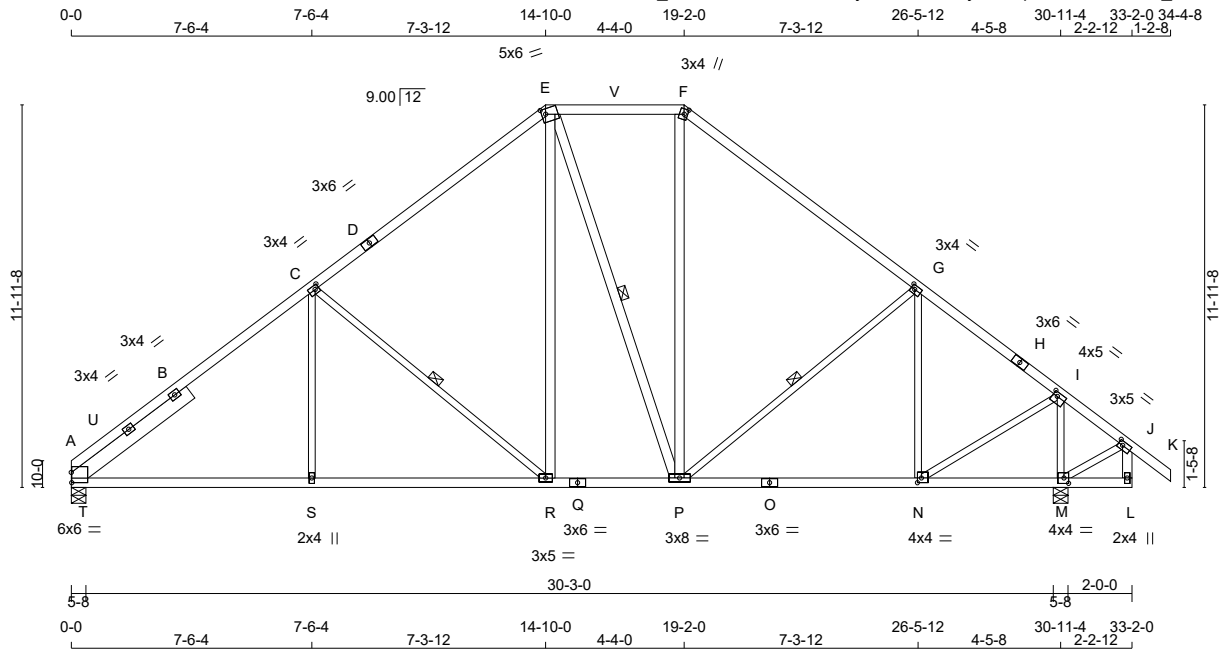

Scale = 1:72.0

TOTAL WEIGHT = 168 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
L - J	2x4	DRY	No.2
A - Q	2x4	DRY	No.2
Q - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
REINFORCING MEMBERS			
HW1	2x6	DRY	No.2
ALL WEBS EXCEPT			
R - E	2x4	DRY	No.2
E - P	2x4	DRY	No.2
P - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMBMR1-I	MT20	6.0	6.0 4.00 0.25
A	RT-t	MT20	3.0	4.0
A	RT-t	MT20	3.0	4.0
C	TMWW-t	MT20	3.0	4.0 1.50 1.50
D	TS-t	MT20	3.0	6.0
E	TTWW-m	MT20	5.0	6.0 2.00 1.50
F	TTWW-m	MT20	3.0	4.0 2.00 1.25
G	TMWW-t	MT20	3.0	4.0 1.50 1.50
H	TS-t	MT20	3.0	6.0
I	TMWW-t	MT20	4.0	5.0 1.50 1.75
J	TMVV-t	MT20	3.0	5.0 1.50 1.75
L	BMV+p	MT20	2.0	4.0
M	BMWW-t	MT20	4.0	4.0 2.00 1.75
N	BMWW-t	MT20	4.0	4.0 1.75 1.50
O	BS-t	MT20	3.0	6.0
P	BMWW-t	MT20	3.0	8.0
Q	BS-t	MT20	3.0	6.0
R	BMWW-t	MT20	3.0	5.0
S	BMW+w	MT20	2.0	4.0

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
A	1479	0	1479	0	0
M	1825	0	1825	0	0

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
A	1041	712 / 0	0 / 0	0 / 0	0 / 0	328 / 0	0 / 0
M	1282	893 / 0	0 / 0	0 / 0	0 / 0	389 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, M

BRACING

FOR SECTION E-F, MAX. PURLIN SPACING = 2.00 FT.
FOR OTHER SECTIONS, TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.96 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 - 1x4 LATERAL BRACE(S) AT 1/2 LENGTH OF C-R, E-P, G-P. DBS = 20-0-0, CBF = 76 LBS.

DBS = DIAGONAL BRACE SPACING (MAX). CBF = CUMULATIVE BRACING FORCE (PER BRACE). FASTEN LATERAL BRACE(S) USING (0.122"x3") SPIRAL NAILS : 1 NAIL FOR 2x3 BRACE(S), 2 FOR 1x4, 2x4, 2x5, 3 FOR 2x6, 4 FOR 2x8, 5 FOR 2x10, AND 6 FOR 2x12.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX LC1 (LC)
FR-TO		FROM	TO		FR-TO		
A-U	-1771 / 0	-77.4	-77.4 0.09 (1)	4.96	S-C	0 / 157	0.05 (4)
U-B	-1393 / 0	-77.4	-77.4 0.49 (1)	4.98	C-R	-606 / 0	0.40 (1)
B-C	-1393 / 0	-77.4	-77.4 0.49 (1)	4.98	R-E	0 / 481	0.08 (1)
C-D	-1256 / 0	-77.4	-77.4 0.57 (1)	5.02	E-P	-169 / 0	0.15 (1)
D-E	-1256 / 0	-77.4	-77.4 0.57 (1)	5.02	P-F	0 / 281	0.05 (1)
E-V	-928 / 0	-84.9	-84.9 0.28 (1)	2.00	P-G	-19 / 3	0.01 (1)
V-F	-928 / 0	-84.9	-84.9 0.28 (1)	2.00	N-G	-566 / 0	0.39 (1)
F-G	-1188 / 0	-77.4	-77.4 0.56 (1)	5.14	N-I	0 / 1276	0.29 (1)
G-H	-1126 / 0	-77.4	-77.4 0.42 (1)	5.43	M-I	-1680 / 0	0.31 (1)
H-I	-1126 / 0	-77.4	-77.4 0.42 (1)	5.43	M-J	-158 / 0	0.03 (1)
I-J	0 / 184	-77.4	-77.4 0.08 (1)	10.00	T-U	0 / 780	0.00 (1)
J-K	0 / 30	-77.4	-77.4 0.09 (1)	10.00	T-B	-866 / 0	0.14 (1)
L-J	0 / 14	0.0	0.0 0.00 (4)	10.00			
A-T	0 / 840	-18.2	-18.2 0.24 (4)	10.00			
T-S	0 / 1446	-18.2	-18.2 0.35 (1)	10.00			
S-R	0 / 1446	-18.2	-18.2 0.35 (1)	10.00			
R-Q	0 / 985	-18.2	-18.2 0.25 (1)	10.00			
Q-P	0 / 985	-18.2	-18.2 0.25 (1)	10.00			
P-O	0 / 939	-18.2	-18.2 0.24 (1)	10.00			
O-N	0 / 939	-18.2	-18.2 0.24 (1)	10.00			
N-M	-141 / 0	-18.2	-18.2 0.13 (4)	6.25			
M-L	0 / 0	-18.2	-18.2 0.05 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.3	PSF
TOTAL LOAD		=	33.6	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON PIGGYBACK TRUSS WITH SLOPES OF 6.00/12 AND -6.00/12 AND RESPECTIVE WALL HEIGHTS OF 0-0 AND 0-0 AND AN ADDITIONAL DEAD LOAD OF 3.0 P.S.F.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CANTILEVER DEFLECTION:
ALLOWABLE DEFL.(LL)= L/120 (0.22")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/120 (0.22")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.57/1.00 (C-E:1), BC=0.35/1.00 (S-T:1), WB=0.40/1.00 (C-R:1), SSI=0.24/1.00 (A-T:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

CONTINUED ON PAGE 2




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN YORK HOMES - GRANELLI HOME CORP - INDIGO 1 ELEV 1	DRWG NO.
NE0618-034	T04	1	1	TRUSS DESC.		PAGE 42 OF 61

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Tue Jun 5 16:52:25 2018 Page 2
ID:9_xLMwZ3WDKc3QXh8cyzSnzB2V3-TyONUqxwi67UK70nZ2o_G2v1v7j0o7EpXI4ltHz9Hjq

PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.90 (F) (INPUT = 0.90)
JSI METAL= 0.44 (I) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



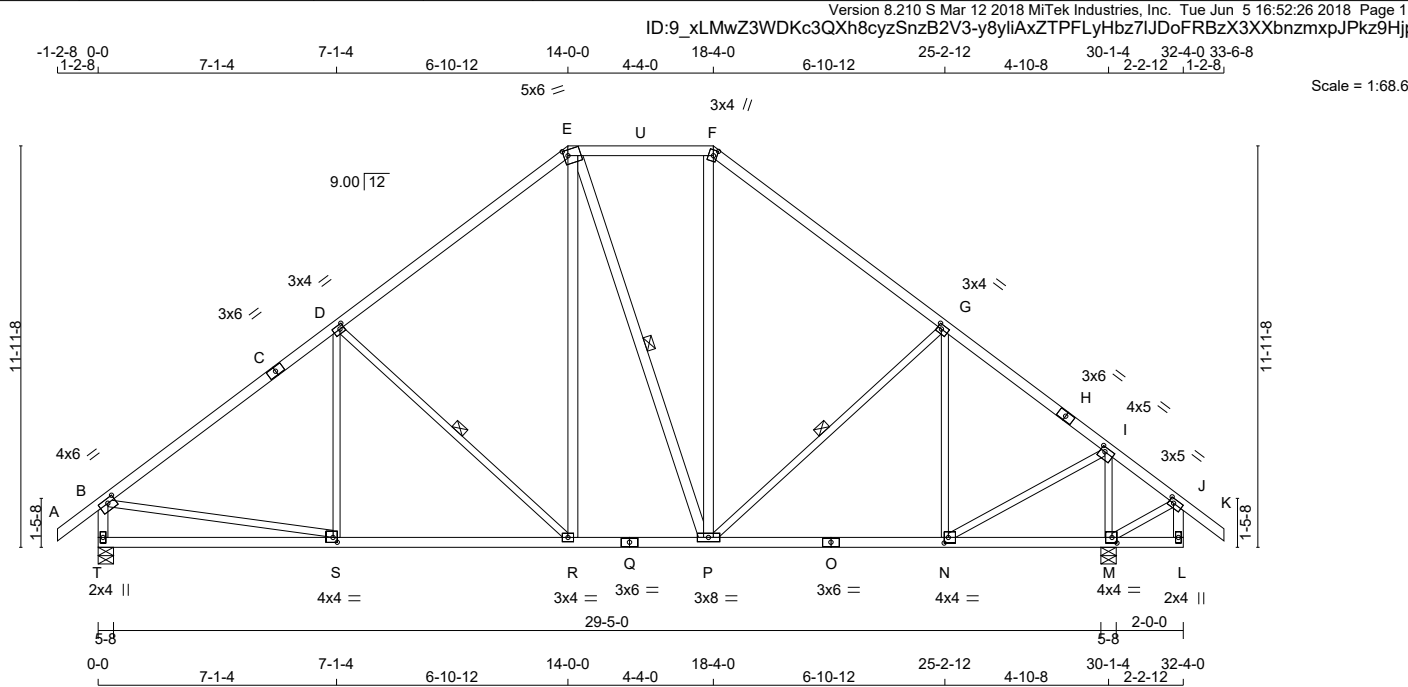

LUMBER				N. L. G. A. RULES	
CHORDS	SIZE	LUMBER	DESCR.		
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
E - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - K	2x4	DRY	No.2	SPF	
T - B	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
T - Q	2x4	DRY	No.2	SPF	
Q - O	2x4	DRY	No.2	SPF	
O - L	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
R - E	2x4	DRY	No.2	SPF	
E - P	2x4	DRY	No.2	SPF	
P - F	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	4.0	6.0	1.50 2.75
C	TS-t	MT20	3.0	6.0	
D	TMWW-t	MT20	3.0	4.0	1.50 1.50
E	TTWW-m	MT20	5.0	6.0	2.00 1.50
F	TTW+m	MT20	3.0	4.0	2.00 1.25
G	TMWW-t	MT20	3.0	4.0	1.50 1.50
H	TS-t	MT20	3.0	6.0	
I	TMWW-t	MT20	4.0	5.0	1.50 1.75
J	TMVW-t	MT20	3.0	5.0	1.50 1.75
L	BMV+p	MT20	2.0	4.0	
M	BMWW1-t	MT20	4.0	4.0	2.00 1.75
N	BMWW-t	MT20	4.0	4.0	2.00 1.50
O	BS-t	MT20	3.0	6.0	
P	BMWWW-t	MT20	3.0	8.0	
Q	BS-t	MT20	3.0	6.0	
R	BMWW-t	MT20	3.0	4.0	
S	BMWW-t	MT20	4.0	4.0	1.75 1.50
T	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	GROSS REACTION	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX
T	1539	0	1539	0	0	5-8	5-8	5-8	
M	1785	0	1785	0	0	5-8	5-8	5-8	

UNFACTORED REACTIONS		1ST LCASE		MAX./MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
T	1081	753 / 0	0 / 0	0 / 0	328 / 0
M	1254	874 / 0	0 / 0	0 / 0	380 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, M

BRACING
FOR SECTION E-F, MAX. PURLIN SPACING = 2.00 FT.
FOR OTHER SECTIONS, TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.54 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 - 1x4 LATERAL BRACE(S) AT 1/ 2 LENGTH OF D-R, E-P, G-P. DBS = 20-0-0 . CBF = 63 LBS.

DBS = DIAGONAL BRACE SPACING (MAX). CBF = CUMULATIVE BRACING FORCE (PER BRACE). FASTEN LATERAL BRACE(S) USING (0.122"x3") SPIRAL NAILS : 1 NAIL FOR 2x3 BRACE(S), 2 FOR 1x4, 2x4, 2x5, 3 FOR 2x6, 4 FOR 2x8, 5 FOR 2x10, AND 6 FOR 2x12.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

C H O R D S				W E B S			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM	TO		FR-TO		
A - B	0 / 30	-77.4	-77.4 0.09 (1)	10.00	S - D	-57 / 105	0.04 (1)
B - C	-1580 / 0	-77.4	-77.4 0.62 (1)	4.54	D - R	-505 / 0	0.32 (1)
C - D	-1580 / 0	-77.4	-77.4 0.62 (1)	4.54	R - E	0 / 430	0.07 (1)
D - E	-1196 / 0	-77.4	-77.4 0.56 (1)	5.12	E - P	-126 / 0	0.11 (1)
E - U	-886 / 0	-84.9	-84.9 0.28 (1)	2.00	P - F	0 / 264	0.04 (1)
U - F	-886 / 0	-84.9	-84.9 0.28 (1)	2.00	P - G	-58 / 0	0.04 (1)
F - G	-1135 / 0	-77.4	-77.4 0.49 (1)	5.35	N - G	-495 / 0	0.38 (1)
G - H	-1122 / 0	-77.4	-77.4 0.38 (1)	5.51	N - I	0 / 1213	0.27 (1)
H - I	-1122 / 0	-77.4	-77.4 0.38 (1)	5.51	M - I	-1638 / 0	0.30 (1)
I - J	0 / 175	-77.4	-77.4 0.11 (1)	10.00	B - S	0 / 1312	0.30 (1)
J - K	0 / 30	-77.4	-77.4 0.09 (1)	10.00	M - J	-141 / 0	0.02 (1)
T - B	-1487 / 0	0.0	0.0 0.15 (1)	6.72			
L - J	0 / 11	0.0	0.0 0.00 (4)	10.00			
T - S	0 / 0	-18.2	-18.2 0.23 (4)	10.00			
S - R	0 / 1295	-18.2	-18.2 0.33 (4)	10.00			
R - Q	0 / 929	-18.2	-18.2 0.23 (1)	10.00			
Q - P	0 / 929	-18.2	-18.2 0.23 (1)	10.00			
P - O	0 / 925	-18.2	-18.2 0.23 (1)	10.00			
O - N	0 / 925	-18.2	-18.2 0.23 (1)	10.00			
N - M	-126 / 0	-18.2	-18.2 0.12 (4)	6.25			
M - L	0 / 0	-18.2	-18.2 0.06 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL	=	23.3 PSF
	DL	=	3.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.3 PSF
TOTAL LOAD	=	33.6	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON PIGGYBACK TRUSS WITH SLOPES OF 6.00/12 AND -6.00/12 AND RESPECTIVE WALL HEIGHTS OF 0-0 AND 0-0 AND AN ADDITIONAL DEAD LOAD OF 3.0 P.S.F.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.00")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (1.00")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.12")

CANTILEVER DEFLECTION:
ALLOWABLE DEFL.(LL)= L/120 (0.22")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/120 (0.22")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.00")

CSI: TC=0.62/1.00 (B-D:1) , BC=0.33/1.00 (R-S:4) , WB=0.38/1.00 (G-N:1) , SSI=0.21/1.00 (B-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
	(PSI)	(PLI)	(PLI)		
	MAX	MIN	MAX	MIN	MAX
MT20	618	354	1667	822	2284

CONTINUED ON PAGE 2


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN YORK HOMES - GRANELLI HOME CORP - INDIGO 1 ELEV 1	DRWG NO.
NE0618-034	T05	4	1	TRUSS DESC.		PAGE 44 OF 61

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Tue Jun 5 16:52:26 2018 Page 2
ID:9_xLMwZ3WDKc3QXh8cyzSnzB2V3-y8yliAxZTPFLyHbz7IJDoFRBzX3XXbnzmxpJPkz9Hjp

PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.90 (N) (INPUT = 0.90)
JSI METAL= 0.49 (S) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



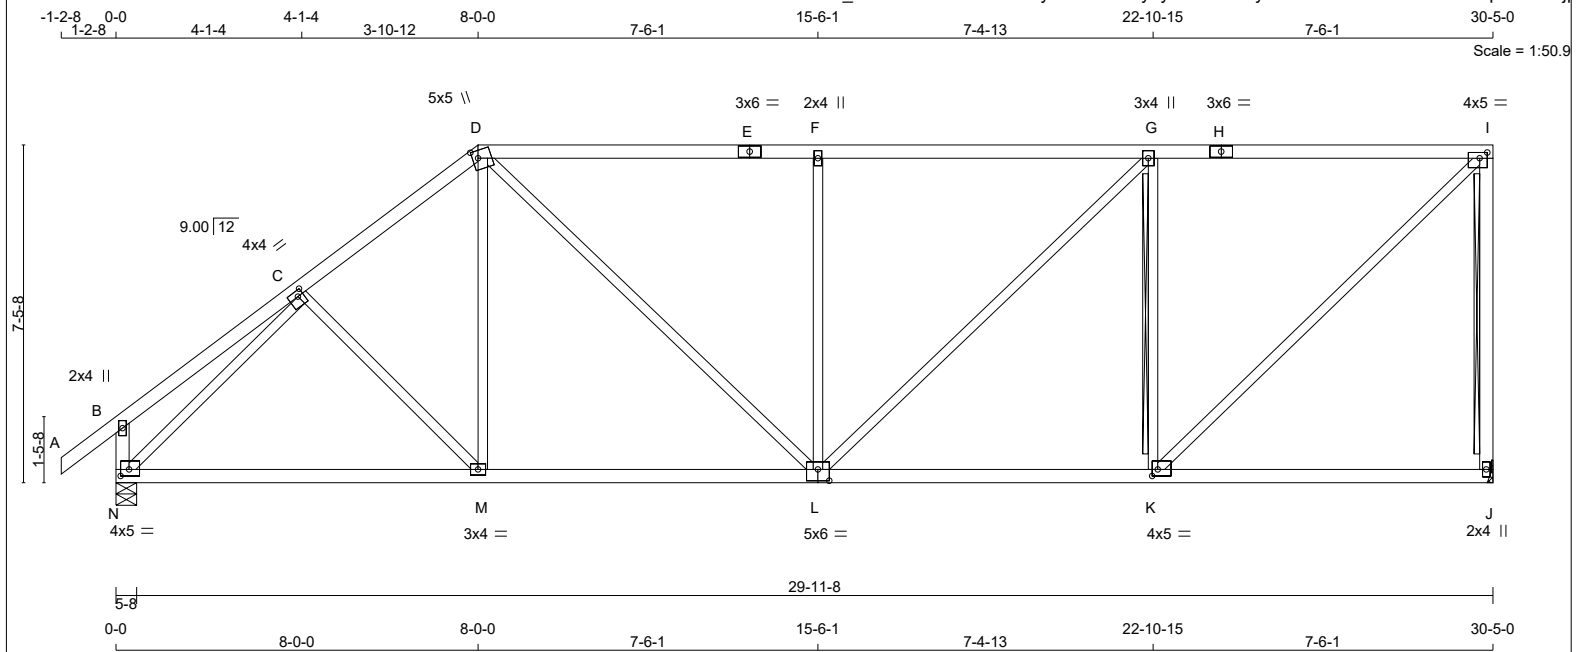

TOTAL WEIGHT = 133 lb [M]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - H	2x4	DRY	No.2	SPF
H - I	2x4	DRY	No.2	SPF
J - I	2x4	DRY	No.2	SPF
N - B	2x4	DRY	No.2	SPF
N - L	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
C	TMWW-t	MT20	4.0	4.0	1.50	1.50
D	TTWW+m	MT20	5.0	5.0	2.00	1.50
E	TS-t	MT20	3.0	6.0		
F	TMW+w	MT20	2.0	4.0		
G	TMWW+t	MT20	3.0	4.0		
H	TS-t	MT20	3.0	6.0		
I	TMVW-t	MT20	4.0	5.0	1.50	2.00
J	BMV1+p	MT20	2.0	4.0		
K	BMWW-t	MT20	4.0	5.0	1.75	1.50
L	BSWWW-t	MT20	5.0	6.0	3.00	3.00
M	BMWW-t	MT20	3.0	4.0		
N	BMVW1-t	MT20	4.0	5.0	1.75	2.25

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
J	1454	0	1454	0
N	1554	0	1554	0

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT J TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

1ST LCASE	MAX./MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	1022	708 / 0	0 / 0	0 / 0	0 / 0	313 / 0	0 / 0
N	1090	769 / 0	0 / 0	0 / 0	0 / 0	321 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.24 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT I-J, G-K

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC1)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 30	-77.4 -77.4	0.09 (1)	10.00	C-M	-26 / 46	0.02 (4)
B-C	0 / 20	-77.4 -77.4	0.19 (1)	10.00	M-D	0 / 182	0.05 (4)
C-D	-1541 / 0	-77.4 -77.4	0.23 (1)	5.07	D-L	0 / 541	0.12 (1)
D-E	-1609 / 0	-77.4 -77.4	0.76 (1)	4.26	L-F	-628 / 0	0.63 (1)
E-F	-1609 / 0	-77.4 -77.4	0.76 (1)	4.26	L-G	0 / 540	0.12 (1)
F-G	-1609 / 0	-77.4 -77.4	0.76 (1)	4.24	K-G	-1010 / 0	0.39 (1)
G-H	-1221 / 0	-77.4 -77.4	0.70 (1)	4.79	K-I	0 / 1688	0.38 (1)
H-I	-1221 / 0	-77.4 -77.4	0.70 (1)	4.79	N-C	-1773 / 0	0.96 (1)
J-I	-1399 / 0	0.0	0.0	4.43 (1)			
N-B	-220 / 0	0.0	0.0	0.02 (1)			
N-M	0 / 1233	-18.2	-18.2	0.37 (4)	10.00		
M-L	0 / 1217	-18.2	-18.2	0.38 (4)	10.00		
L-K	0 / 1221	-18.2	-18.2	0.34 (4)	10.00		
K-J	0 / 0	-18.2	-18.2	0.25 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
	DL = 3.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.3	PSF
TOTAL LOAD	= 33.6	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.01")
CALCULATED VERT. DEFL.(LL)= L/999 (0.08")
ALLOWABLE DEFL.(TL)= L/360 (1.01")
CALCULATED VERT. DEFL.(TL)= L/999 (0.16")

CSI: TC=0.76/1.00 (F-G:1), BC=0.38/1.00 (L-M:4), WB=0.96/1.00 (C-N:1), SSI=0.27/1.00 (G-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (C) (INPUT = 0.90)
JSI METAL= 0.65 (C) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



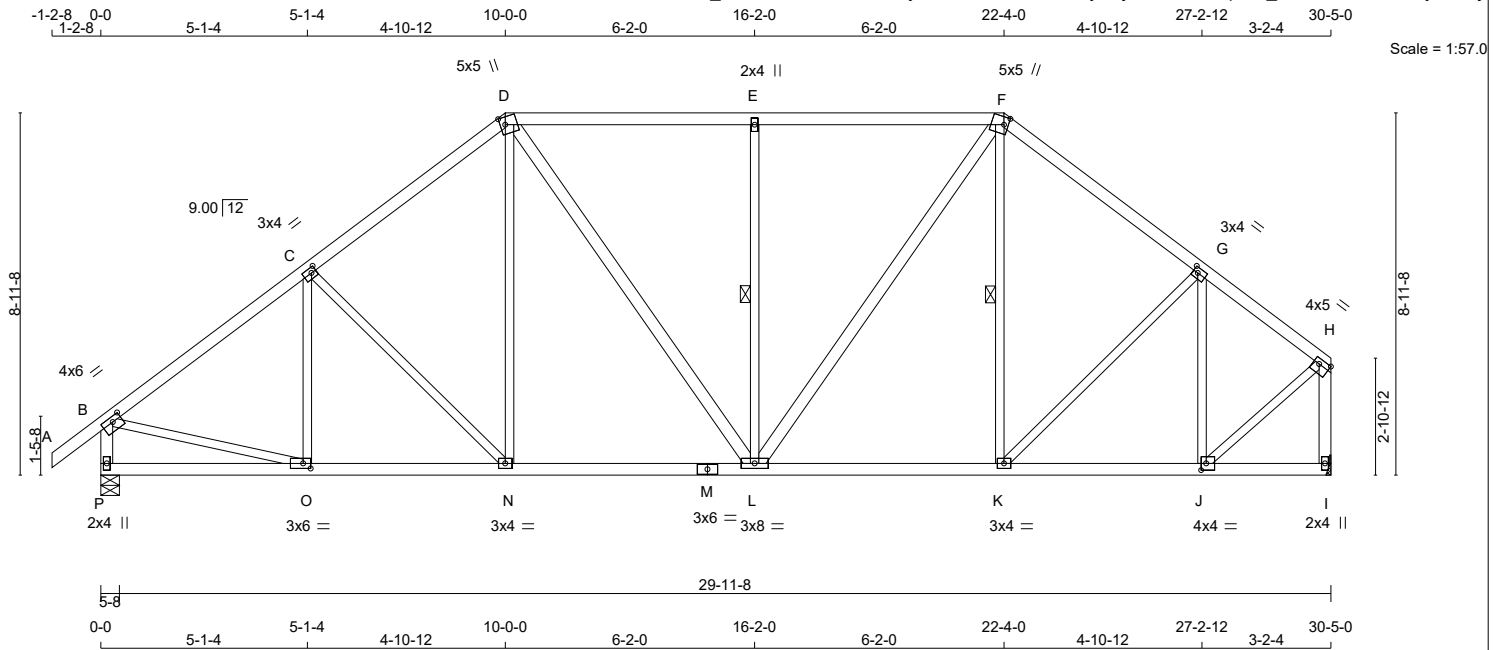

TOTAL WEIGHT = 150 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
P - B	2x4	DRY	No.2	SPF
I - H	2x4	DRY	No.2	SPF
P - M	2x4	DRY	No.2	SPF
M - I	2x4	DRY	No.2	SPF
ALL WEBS 2x3 DRY No.2 SPF				
EXCEPT				
D - L	2x4	DRY	No.2	SPF
L - F	2x4	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	6.0	1.50	2.75
C	TMWW-t	MT20	3.0	4.0	1.50	1.50
D	TTWW+m	MT20	5.0	5.0	2.25	1.50
E	TMW+w	MT20	2.0	4.0		
F	TTWW+m	MT20	5.0	5.0	2.25	1.25
G	TMWW-t	MT20	3.0	4.0	1.50	1.50
H	TMVW-t	MT20	4.0	5.0	1.50	Edge
I	BMV1+p	MT20	2.0	4.0		
J	BMWW-t	MT20	4.0	4.0	2.00	1.50
K	BMWW-t	MT20	3.0	4.0		
L	BMWW-t	MT20	3.0	8.0		
M	BS-t	MT20	3.0	6.0		
N	BMWW-t	MT20	3.0	4.0		
O	BMWW-t	MT20	3.0	6.0	1.50	2.25
P	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	GROSS REACTION	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BRG
P	1554	0	1554	0	0	5-8	5-8		
I	1454	0	1454	0	0	MECHANICAL			

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT I TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
P	1090	769 / 0	0 / 0	0 / 0	0 / 0	321 / 0	0 / 0
I	1022	708 / 0	0 / 0	0 / 0	0 / 0	313 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.95 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 - 1x4 LATERAL BRACE(S) AT 1/2 LENGTH OF E-L, F-K. DBS = 20-0-0 . CBF = 73 LBS.

DBS = DIAGONAL BRACE SPACING (MAX). CBF = CUMULATIVE BRACING FORCE (PER BRACE). FASTEN LATERAL BRACE(S) USING (0.122"x3") SPIRAL NAILS : 1 NAIL FOR 2x3 BRACE(S), 2 FOR 1x4, 2x4, 2x5, 3 FOR 2x6, 4 FOR 2x8, 5 FOR 2x10, AND 6 FOR 2x12.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 30	-77.4 -77.4	0.09 (1)	10.00	O-C	-191 / 26	0.08 (1)
B-C	-1596 / 0	-77.4 -77.4	0.29 (1)	4.95	C-N	-236 / 0	0.22 (1)
C-D	-1445 / 0	-77.4 -77.4	0.28 (1)	5.16	N-D	0 / 268	0.06 (1)
D-E	-1318 / 0	-77.4 -77.4	0.41 (1)	5.15	D-L	0 / 317	0.05 (1)
E-F	-1318 / 0	-77.4 -77.4	0.41 (1)	5.15	L-E	-585 / 0	0.30 (1)
F-G	-1279 / 0	-77.4 -77.4	0.24 (1)	5.45	L-F	0 / 541	0.09 (1)
G-H	-1062 / 0	-77.4 -77.4	0.19 (1)	5.90	K-F	-22 / 71	0.02 (4)
P-B	-1514 / 0	0.0 0.0	0.16 (1)	6.68	K-G	0 / 181	0.04 (1)
I-H	-1432 / 0	0.0 0.0	0.22 (1)	6.82	J-G	-629 / 0	0.26 (1)
					B-O	0 / 1330	0.30 (1)
P-O	0 / 0	-18.2 -18.2	0.10 (4)	10.00	J-H	0 / 1125	0.25 (1)
O-N	0 / 1299	-18.2 -18.2	0.27 (1)	10.00			
N-M	0 / 1134	-18.2 -18.2	0.26 (1)	10.00			
M-L	0 / 1134	-18.2 -18.2	0.26 (1)	10.00			
L-K	0 / 1004	-18.2 -18.2	0.24 (1)	10.00			
K-J	0 / 876	-18.2 -18.2	0.21 (1)	10.00			
J-I	0 / 0	-18.2 -18.2	0.06 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL	=	23.3 PSF
	DL	=	3.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.3 PSF
TOTAL LOAD	=	33.6	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.01")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (1.01")
CALCULATED VERT. DEFL.(TL) = L/999 (0.10")

CSI: TC=0.41/1.00 (D-E:1), BC=0.27/1.00 (N-O:1), WB=0.30/1.00 (E-L:1), SSI=0.23/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (G) (INPUT = 0.90)
JSI METAL= 0.44 (B) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



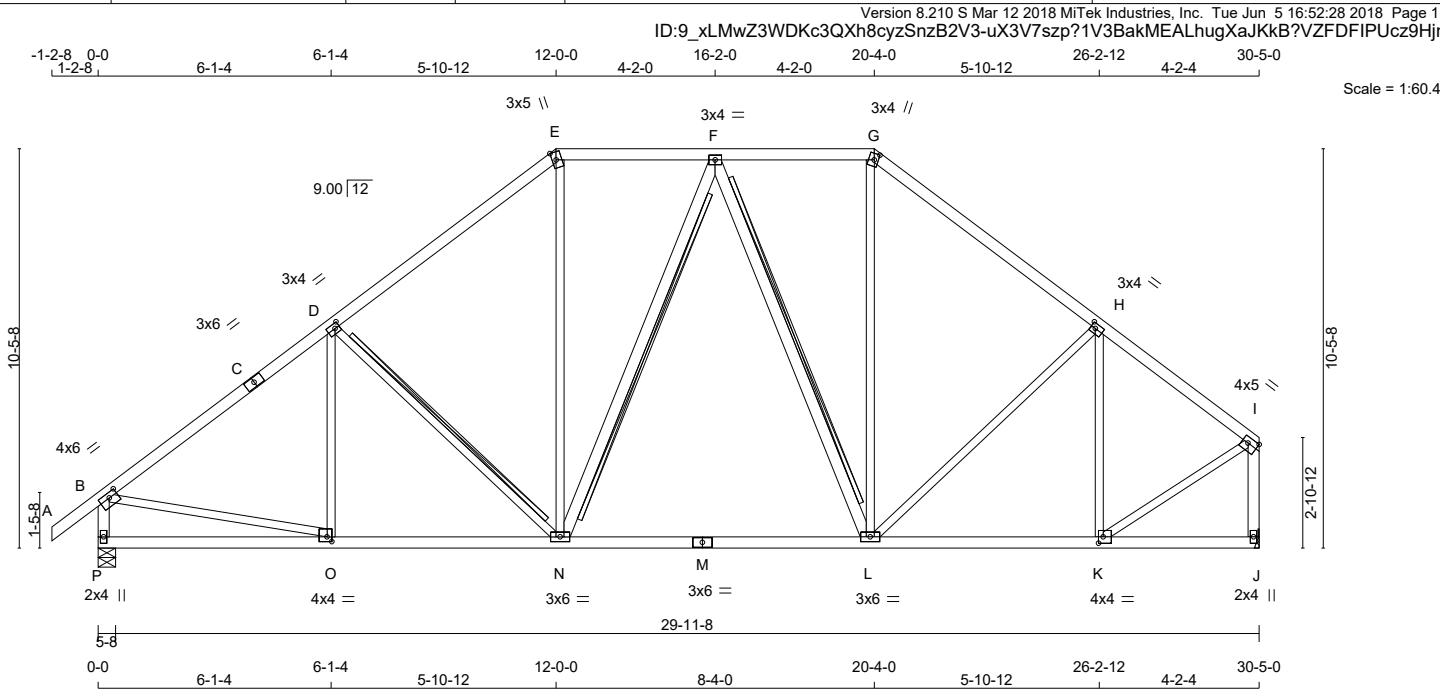

TOTAL WEIGHT = 152 lb
[M][F]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
P - B	2x4	DRY	No.2	SPF
J - I	2x4	DRY	No.2	SPF
P - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
N - F	2x4	DRY	No.2	SPF
F - L	2x4	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	4.0	6.0	1.50 2.75
C	TS-t	MT20	3.0	6.0	
D	TMWW-t	MT20	3.0	4.0	1.50 1.50
E	TTW+m	MT20	3.0	5.0	Edge 1.25
F	TMWW-t	MT20	3.0	4.0	
G	TTW+m	MT20	3.0	4.0	2.00 1.25
H	TMWW-t	MT20	3.0	4.0	1.50 1.50
I	TMVW-t	MT20	4.0	5.0	1.75 Edge
J	BMV1+p	MT20	2.0	4.0	
K	BMWW-t	MT20	4.0	4.0	2.00 1.50
L	BMWW-t	MT20	3.0	6.0	
M	BS-t	MT20	3.0	6.0	
N	BMWW-t	MT20	3.0	6.0	
O	BMWW-t	MT20	4.0	4.0	1.50 1.50
P	BMV1+p	MT20	2.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT		VERT	HORZ	UPLIFT	IN-SX
P		1554	0	0	5-8
J		1454	0	0	MECHANICAL

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT J TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
P	1090	769 / 0	0 / 0	0 / 0	0 / 0	321 / 0	0 / 0
J	1022	708 / 0	0 / 0	0 / 0	0 / 0	313 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT D-N, F-N, F-L

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH
FR-TO		FROM TO		FR-TO			
A-B	0 / 30	-77.4 -77.4	0.09 (1)	10.00	O-D	-129 / 58	0.07 (1)
B-C	-1605 / 0	-77.4 -77.4	0.43 (1)	4.77	D-N	-366 / 0	0.19 (1)
C-D	-1605 / 0	-77.4 -77.4	0.43 (1)	4.77	N-E	0 / 488	0.11 (1)
D-E	-1344 / 0	-77.4 -77.4	0.40 (1)	5.14	N-F	-111 / 8	0.10 (1)
E-F	-1051 / 0	-77.4 -77.4	0.18 (1)	5.94	F-L	-307 / 0	0.27 (1)
F-G	-978 / 0	-77.4 -77.4	0.17 (1)	6.10	L-G	0 / 421	0.09 (1)
G-H	-1245 / 0	-77.4 -77.4	0.35 (1)	5.36	L-H	0 / 16	0.01 (4)
H-I	-1176 / 0	-77.4 -77.4	0.29 (1)	5.55	K-H	-504 / 0	0.29 (1)
P-B	-1507 / 0	0.0 0.0	0.16 (1)	6.68	B-O	0 / 1333	0.30 (1)
J-I	-1423 / 0	0.0 0.0	0.22 (1)	6.84	K-I	0 / 1138	0.26 (1)
P-O	0 / 0	-18.2 -18.2	0.14 (4)	10.00			
O-N	0 / 1311	-18.2 -18.2	0.32 (1)	10.00			
N-M	0 / 1092	-18.2 -18.2	0.29 (1)	10.00			
M-L	0 / 1092	-18.2 -18.2	0.29 (1)	10.00			
L-K	0 / 971	-18.2 -18.2	0.28 (4)	10.00			
K-J	0 / 0	-18.2 -18.2	0.09 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL	=	23.3 PSF
	DL	=	3.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.3 PSF
TOTAL LOAD	=	33.6	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.01")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (1.01")
CALCULATED VERT. DEFL.(TL) = L/999 (0.15")

CSI: TC=0.43/1.00 (B-D:1), BC=0.32/1.00 (N-O:1), WB=0.30/1.00 (B-O:1), SSI=0.18/1.00 (B-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (G) (INPUT = 0.90)
JSI METAL= 0.49 (O) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



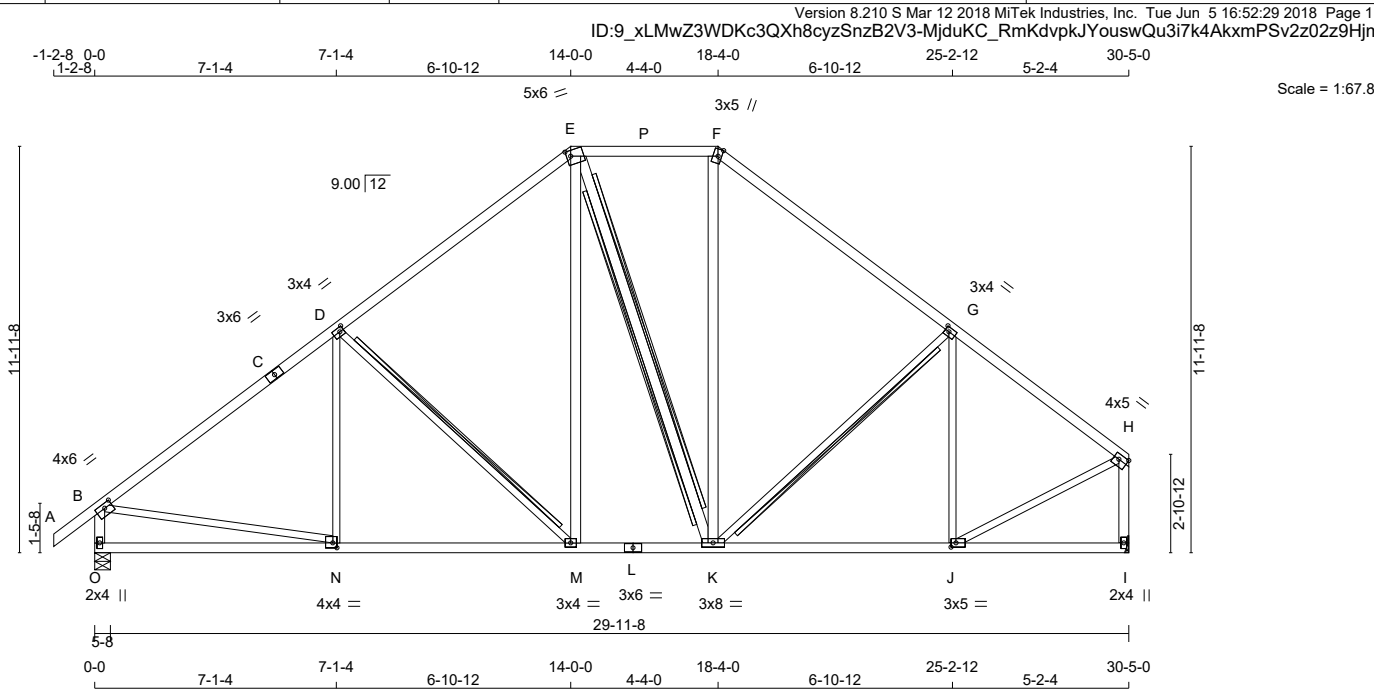

TOTAL WEIGHT = 2 X 158 = 315 lb
[M][F]

LUMBER				DESCR.	
CHORDS	SIZE	DRY	LUMBER	SPF	
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
E - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
O - B	2x4	DRY	No.2	SPF	
I - H	2x4	DRY	No.2	SPF	
O - L	2x4	DRY	No.2	SPF	
L - I	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	
M - E	2x4	DRY	No.2	SPF	
E - K	2x4	DRY	No.2	SPF	
K - F	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	4.0	6.0	1.50 2.75
C	TS-t	MT20	3.0	6.0	
D	TMWW-t	MT20	3.0	4.0	1.50 1.50
E	TTWW-m	MT20	5.0	6.0	2.00 1.50
F	TTWW-m	MT20	3.0	5.0	Edge 1.25
G	TMVW-t	MT20	3.0	4.0	1.50 1.50
H	TMVW-t	MT20	4.0	5.0	1.75 Edge
I	BMV1+p	MT20	2.0	4.0	
J	BMWW-t	MT20	3.0	5.0	1.50 1.75
K	BMWWW-t	MT20	3.0	8.0	
L	BS-t	MT20	3.0	6.0	
M	BMWW-t	MT20	3.0	4.0	
N	BMWW-t	MT20	4.0	4.0	1.75 1.50
O	BMV1+p	MT20	2.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	DOWN	HORIZ	UPLIFT	IN-SX	IN-SX	
O	1570	0	1570	0	5-8	5-8	
I	1471	0	1471	0	MECHANICAL		

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT I TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN	COMPONENT REACTIONS				
O	1102	769 / 0	0 / 0	0 / 0	0 / 0	333 / 0	0 / 0
I	1035	708 / 0	0 / 0	0 / 0	0 / 0	327 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O

BRACING

FOR SECTION E-F, MAX. PURLIN SPACING = 2.00 FT.
FOR OTHER SECTIONS, TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.49 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT D-M, G-K
2x4 DRY SPF No.2 I-BRACE AT E-K

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 30	-77.4 -77.4	0.09 (1)	10.00	N-D	-62 / 104	0.05 (1)
B-C	-1622 / 0	-77.4 -77.4	0.62 (1)	4.49	D-M	-500 / 0	0.37 (1)
C-D	-1622 / 0	-77.4 -77.4	0.62 (1)	4.49	M-E	0 / 428	0.07 (1)
D-E	-1242 / 0	-77.4 -77.4	0.56 (1)	5.04	E-K	-94 / 0	0.09 (1)
E-F	-934 / 0	-84.9 -84.9	0.28 (1)	2.00	K-F	0 / 302	0.05 (1)
P-F	-934 / 0	-84.9 -84.9	0.28 (1)	2.00	K-G	-163 / 0	0.12 (1)
F-G	-1196 / 0	-77.4 -77.4	0.50 (1)	5.24	J-G	-394 / 0	0.30 (1)
G-H	-1270 / 0	-77.4 -77.4	0.42 (1)	5.21	B-N	0 / 1346	0.30 (1)
O-B	-1518 / 0	0.0 0.0	0.16 (1)	6.67	J-H	0 / 1171	0.26 (1)
I-H	-1437 / 0	0.0 0.0	0.22 (1)	6.81			
O-N	0 / 0	-18.2 -18.2	0.23 (4)	10.00			
N-M	0 / 1329	-18.2 -18.2	0.34 (1)	10.00			
M-L	0 / 965	-18.2 -18.2	0.23 (1)	10.00			
L-K	0 / 965	-18.2 -18.2	0.23 (1)	10.00			
K-J	0 / 1050	-18.2 -18.2	0.26 (1)	10.00			
J-I	0 / 0	-18.2 -18.2	0.17 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.3	PSF
TOTAL LOAD		=	33.6	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON PIGGYBACK TRUSS WITH SLOPES OF 6.00/12 AND -6.00/12 AND RESPECTIVE WALL HEIGHTS OF 0-0 AND 0-0 AND AN ADDITIONAL DEAD LOAD OF 3.0 P.S.F.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.01")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (1.01")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.62/1.00 (B-D:1), BC=0.34/1.00 (M-N:1), WB=0.37/1.00 (D-M:1), SSI=0.21/1.00 (B-D:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (N) (INPUT = 0.90)
JSI METAL= 0.50 (N) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
NE0618-034	T10	1	1	GREEN YORK HOMES - GRANELLI HOME CORP - INDIGO 1 ELEV 1	PAGE 49 OF 61

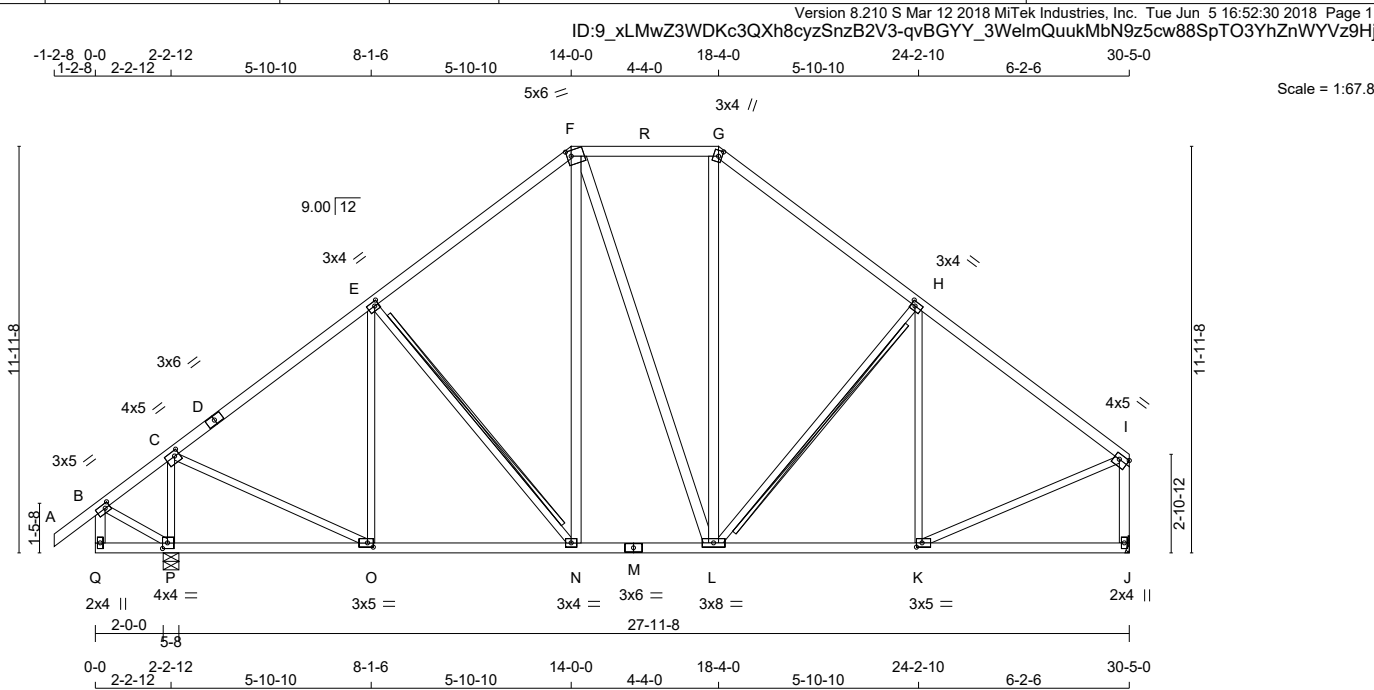

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
Q - B	2x4	DRY	No.2	SPF
J - I	2x4	DRY	No.2	SPF
Q - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
N - F	2x4	DRY	No.2	SPF
F - L	2x4	DRY	No.2	SPF
L - G	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	3.0	5.0	1.50 1.75
C	TMWW-t	MT20	4.0	5.0	1.75 1.75
D	TS-t	MT20	3.0	6.0	
E	TMWW-t	MT20	3.0	4.0	1.50 1.50
F	TTWW-m	MT20	5.0	6.0	2.00 1.50
G	TTW+m	MT20	3.0	4.0	2.00 1.25
H	TMWW-t	MT20	3.0	4.0	1.50 1.50
I	TMVW-t	MT20	4.0	5.0	1.75 Edge
J	BMV1+p	MT20	2.0	4.0	
K	BMWW-t	MT20	3.0	5.0	1.50 2.00
L	BMWW-t	MT20	3.0	8.0	
M	BS-t	MT20	3.0	6.0	
N	BMWW-t	MT20	3.0	4.0	
O	BMWW-t	MT20	3.0	5.0	1.50 2.00
P	BMWW1-t	MT20	4.0	4.0	2.00 1.75
Q	BMV+p	MT20	2.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
P	1694	0	1694	0
J	1347	0	1347	0

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT J TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
P	1189	829 / 0	0 / 0	0 / 0	0 / 0	360 / 0	0 / 0
J	948	648 / 0	0 / 0	0 / 0	0 / 0	301 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P

BRACING

FOR SECTION F-G, MAX. PURLIN SPACING = 2.00 FT.
FOR OTHER SECTIONS, TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.40 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT E-N, H-L

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 30	-77.4 -77.4 0.09 (1)	10.00	P-C	-1546 / 0	0.28 (1)	
B-C	0 / 151	-77.4 -77.4 0.24 (1)	10.00	C-O	0 / 1070	0.24 (1)	
C-D	-1086 / 0	-77.4 -77.4 0.33 (1)	5.67	O-E	-351 / 0	0.36 (1)	
D-E	-1086 / 0	-77.4 -77.4 0.33 (1)	5.67	E-N	-142 / 0	0.10 (1)	
E-F	-1016 / 0	-77.4 -77.4 0.35 (1)	5.79	N-F	0 / 201	0.03 (1)	
F-R	-801 / 0	-84.9 -84.9 0.28 (1)	2.00	F-L	0 / 32	0.01 (1)	
R-G	-801 / 0	-84.9 -84.9 0.28 (1)	2.00	L-G	0 / 249	0.04 (1)	
G-H	-1035 / 0	-77.4 -77.4 0.39 (1)	5.68	H-H	-253 / 0	0.18 (1)	
H-I	-1167 / 0	-77.4 -77.4 0.41 (1)	5.40	K-H	-269 / 21	0.28 (1)	
Q-B	-7 / 0	0.0 0.0 0.00 (1)	7.81	B-P	-97 / 0	0.02 (1)	
J-I	-1302 / 0	0.0 0.0 0.20 (1)	7.08	K-I	0 / 1039	0.23 (1)	
Q-P	0 / 0	-18.2 -18.2 0.10 (4)	10.00				
P-O	-87 / 0	-18.2 -18.2 0.10 (4)	6.25				
O-N	0 / 879	-18.2 -18.2 0.21 (1)	10.00				
N-M	0 / 790	-18.2 -18.2 0.18 (1)	10.00				
M-L	0 / 790	-18.2 -18.2 0.18 (1)	10.00				
L-K	0 / 960	-18.2 -18.2 0.25 (4)	10.00				
K-J	0 / 0	-18.2 -18.2 0.17 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.3	PSF
TOTAL LOAD	=	33.6	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON PIGGYBACK TRUSS WITH SLOPES OF 6.00/12 AND -6.00/12 AND RESPECTIVE WALL HEIGHTS OF 0-0 AND 0-0 AND AN ADDITIONAL DEAD LOAD OF 3.0 P.S.F.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.94")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL)= L/360 (0.94")
CALCULATED VERT. DEFL.(TL) = L/999 (0.08")

CANTILEVER DEFLECTION:
ALLOWABLE DEFL.(LL)= L/120 (0.22")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/120 (0.22")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.41/1.00 (H-I:1), BC=0.25/1.00 (K-L:4), WB=0.36/1.00 (E-O:1), SSI=0.18/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

CONTINUED ON PAGE 2




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN YORK HOMES - GRANELLI HOME CORP - INDIGO 1 ELEV 1	DRWG NO.
NE0618-034	T10	1	1	TRUSS DESC.		PAGE 50 OF 61

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Tue Jun 5 16:52:30 2018 Page 2
ID:9 xLMwZ3WDKc3QXh8cyzSnzB2V3-qvBGYY 3WelmQuukMbN9z5cw88SpTO3YhZnWYVz9HJ

PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.89 (G) (INPUT = 0.90)
JSI METAL= 0.43 (C) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



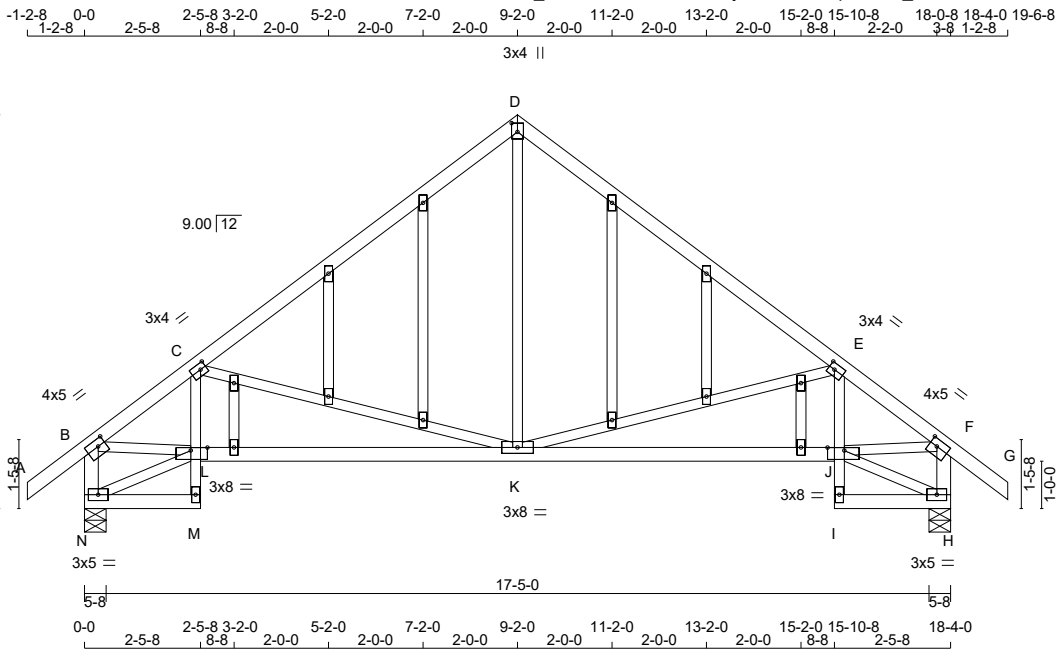

Scale = 1:48.8

TOTAL WEIGHT = 95 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
N - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
N - M	2x4	DRY	No.2
M - C	2x3	DRY	No.2
L - J	2x4	DRY	No.2
I - E	2x3	DRY	No.2
I - H	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			
GABLE STUDS SPACED AT 2'-0" OC.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	4.0	5.0	1.75 2.00
C	TMVW-t	MT20	3.0	4.0	1.50 1.50
D	TTW+p	MT20	3.0	4.0	2.25 1.50
E	TMVW-t	MT20	3.0	4.0	1.50 1.50
F	TMVW-t	MT20	4.0	5.0	1.75 2.00
H	BMVW1-t	MT20	3.0	5.0	
I	BMV+p	MT20	2.0	4.0	
J	BVMWW-I	MT20	3.0	8.0	0.75 4.25
K	BVMWW-t	MT20	3.0	8.0	
L	BVMWW-I	MT20	3.0	8.0	0.75 4.25
M	BMV+p	MT20	2.0	4.0	
N	BVMW1-t	MT20	3.0	5.0	
O, P, Q, R, S, T, U, V, W, X, Y, Z					
O	NP+w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQRD
JT	GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
N	977	0	977	0	5-8
H	977	0	977	0	5-8

UNFACTORED REACTIONS		1ST LCASE	MAX./MIN. COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
N	684	487 / 0	0 / 0	0 / 0	0 / 0	197 / 0	0 / 0
H	684	487 / 0	0 / 0	0 / 0	0 / 0	197 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.20 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING				TOTAL LOAD CASES: (4)			
CHORDS		WEBS		CHORDS		WEBS	
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH	MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH
FR-TO		FROM TO		FR-TO		FROM TO	
A-B	0 / 30	-77.4 -77.4	0.09 (1)	10.00	K-D	0 / 451	0.10 (1)
B-C	-1317 / 0	-77.4 -77.4	0.36 (1)	5.20	K-E	-559 / 0	0.54 (1)
C-D	-764 / 0	-77.4 -77.4	0.45 (1)	6.24	C-K	-559 / 0	0.54 (1)
D-E	-764 / 0	-77.4 -77.4	0.45 (1)	6.24	N-L	-14 / 0	0.00 (1)
E-F	-1317 / 0	-77.4 -77.4	0.36 (1)	5.20	B-L	0 / 1121	0.25 (1)
F-G	0 / 30	-77.4 -77.4	0.09 (1)	10.00	J-H	-14 / 0	0.00 (1)
N-B	-950 / 0	0.0 0.0	0.10 (1)	7.81	J-F	0 / 1121	0.25 (1)
H-F	-950 / 0	0.0 0.0	0.10 (1)	7.81			
N-M	0 / 13	-18.2 -18.2	0.03 (4)	10.00			
M-L	0 / 24	0.0 0.0	0.04 (1)	10.00			
L-C	0 / 60	0.0 0.0	0.04 (1)	10.00			
L-K	0 / 1127	-18.3 -18.3	0.32 (1)	10.00			
K-J	0 / 1127	-18.3 -18.3	0.32 (1)	10.00			
I-J	0 / 24	0.0 0.0	0.04 (1)	10.00			
J-E	0 / 60	0.0 0.0	0.04 (1)	10.00			
I-H	0 / 13	-18.2 -18.2	0.03 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.61")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL)= L/360 (0.61")
CALCULATED VERT. DEFL.(TL) = L/999 (0.09")

CSI: TC=0.45/1.00 (C-D:1), BC=0.32/1.00 (J-K:1),
WB=0.54/1.00 (E-K:1), SSI=0.19/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (F) (INPUT = 0.90)
JSI METAL= 0.43 (B) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



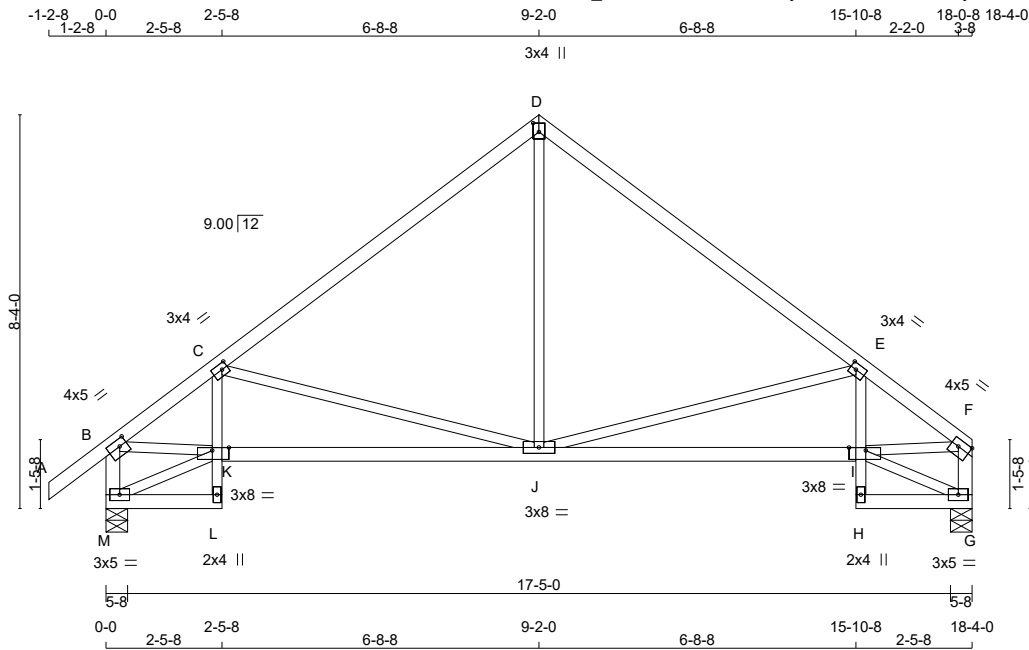

Scale = 1:48.8

TOTAL WEIGHT = 79 lb

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
M - B	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
M - L	2x4	DRY	No.2	SPF
L - C	2x3	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF
H - E	2x3	DRY	No.2	SPF
H - G	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	5.0	1.75	2.00
C	TMVW-t	MT20	3.0	4.0	1.50	1.50
D	TTW+p	MT20	3.0	4.0	2.25	1.50
E	TMVW-t	MT20	3.0	4.0	1.50	1.50
F	TMVW-t	MT20	4.0	5.0	1.75	Edge
G	BMVW1-t	MT20	3.0	5.0		
H	BMV+p	MT20	2.0	4.0		
I	BVMWW-I	MT20	3.0	8.0	0.75	4.25
J	BVMWW-t	MT20	3.0	8.0		
K	BVMWW-I	MT20	3.0	8.0	0.75	4.25
L	BMV+p	MT20	2.0	4.0		
M	BMVW1-t	MT20	3.0	5.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
M	977	0	977	0	5-8	5-8
G	876	0	876	0	5-8	5-8

UNFACTORED REACTIONS							
	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
M	684	487 / 0	0 / 0	0 / 0	0 / 0	197 / 0	0 / 0
G	616	427 / 0	0 / 0	0 / 0	0 / 0	189 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, G

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.20 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD LC1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD LC1 (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0 / 30	-77.4	-77.4	0.09 (1)	10.00	J-D	0 / 451
B-C	-1317 / 0	-77.4	-77.4	0.36 (1)	5.20	J-E	-559 / 0
C-D	-764 / 0	-77.4	-77.4	0.45 (1)	6.24	C-J	-559 / 0
D-E	-764 / 0	-77.4	-77.4	0.45 (1)	6.24	M-K	-14 / 0
E-F	-1317 / 0	-77.4	-77.4	0.36 (1)	5.20	B-K	0 / 1121
M-B	-950 / 0	0.0	0.0	0.10 (1)	7.81	I-G	-14 / 0
G-F	-849 / 0	0.0	0.0	0.09 (1)	7.81	I-F	0 / 1121
M-L	0 / 13	-18.2	-18.2	0.03 (4)	10.00		
L-K	0 / 24	0.0	0.0	0.04 (1)	10.00		
K-C	0 / 60	0.0	0.0	0.04 (1)	10.00		
K-J	0 / 1127	-18.3	-18.3	0.32 (1)	10.00		
J-I	0 / 1127	-18.3	-18.3	0.32 (1)	10.00		
H-I	0 / 24	0.0	0.0	0.04 (1)	10.00		
I-E	0 / 60	0.0	0.0	0.04 (1)	10.00		
H-G	0 / 13	-18.2	-18.2	0.03 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.61")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL)= L/360 (0.61")
CALCULATED VERT. DEFL.(TL) = L/999 (0.09")

CSI: TC=0.45/1.00 (D-E:1), BC=0.32/1.00 (J-K:1), WB=0.54/1.00 (C-J:1), SSI=0.19/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (F) (INPUT = 0.90)
JSI METAL= 0.43 (F) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



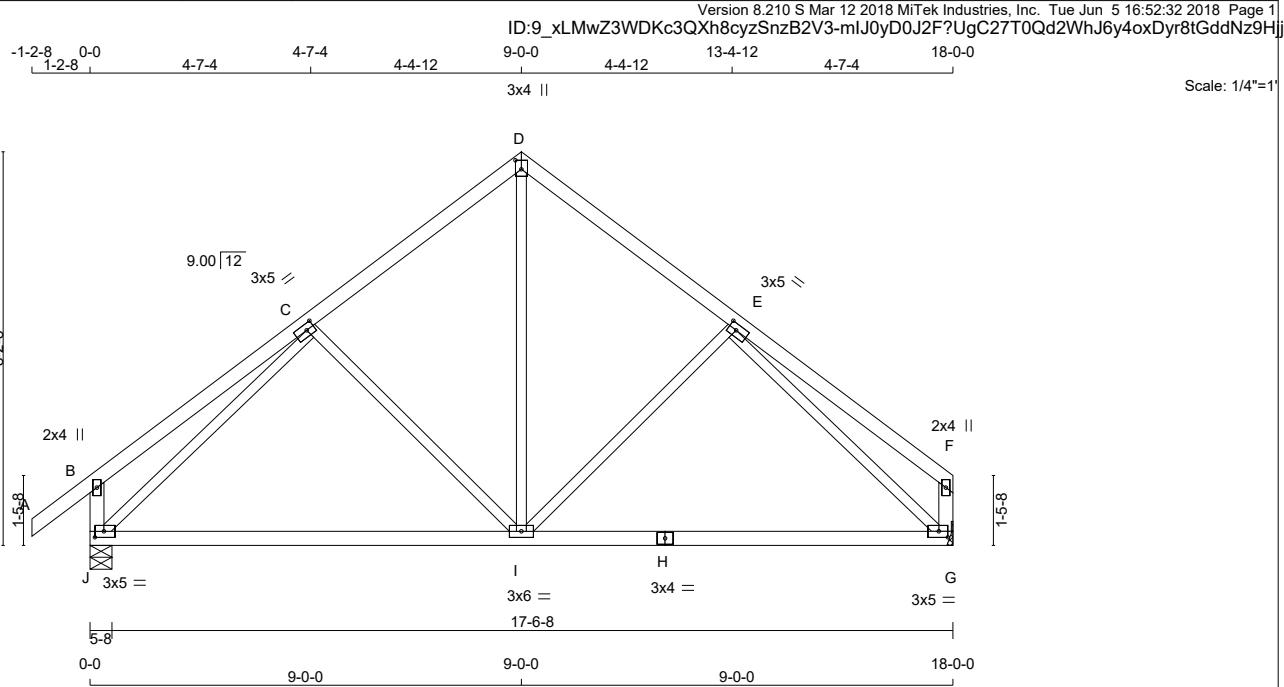

TOTAL WEIGHT = 2 X 76 = 153 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
J - B	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
H - G	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	2.0	4.0	
C	TMWW-t	MT20	3.0	5.0	1.50 2.00
D	TTW+p	MT20	3.0	4.0	2.25 1.50
E	TMWW-t	MT20	3.0	5.0	1.50 2.00
F	TMV+p	MT20	2.0	4.0	
G	BMVW1-t	MT20	3.0	5.0	1.50 2.25
H	BS-t	MT20	3.0	4.0	
I	BMVWW-t	MT20	3.0	6.0	
J	BMVW1-t	MT20	3.0	5.0	1.50 2.25

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
J	961	0	961	0	0
G	861	0	861	0	0

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT G TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	673	480 / 0	0 / 0	0 / 0	0 / 0	0 / 0	193 / 0	0 / 0
G	605	419 / 0	0 / 0	0 / 0	0 / 0	0 / 0	185 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLINE SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 30	-77.4	-77.4 0.09 (1)	I-D	0 / 503	0.11 (1)	
B-C	0 / 25	-77.4	-77.4 0.25 (1)	I-E	-212 / 0	0.15 (1)	
C-D	-667 / 0	-77.4	-77.4 0.20 (1)	C-I	-212 / 0	0.15 (1)	
D-E	-667 / 0	-77.4	-77.4 0.20 (1)	J-C	-941 / 0	0.66 (1)	
E-F	0 / 25	-77.4	-77.4 0.25 (1)	E-G	-941 / 0	0.66 (1)	
J-B	-233 / 0	0.0	0.0 0.02 (1)				
G-F	-132 / 0	0.0	0.0 0.01 (1)				
J-I	0 / 664	-18.2	-18.2 0.47 (4)				
I-H	0 / 664	-18.2	-18.2 0.47 (4)				
H-G	0 / 664	-18.2	-18.2 0.47 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.3	PSF
TOTAL LOAD		=	33.6	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.60")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.60")
CALCULATED VERT. DEFL.(TL) = L/999 (0.15")

CSI: TC=0.25/1.00 (B-C:1), BC=0.47/1.00 (I-J:4), WB=0.66/1.00 (C-J:1), SSI=0.14/1.00 (I-J:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (G) (INPUT = 0.90)
JSI METAL= 0.27 (H) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



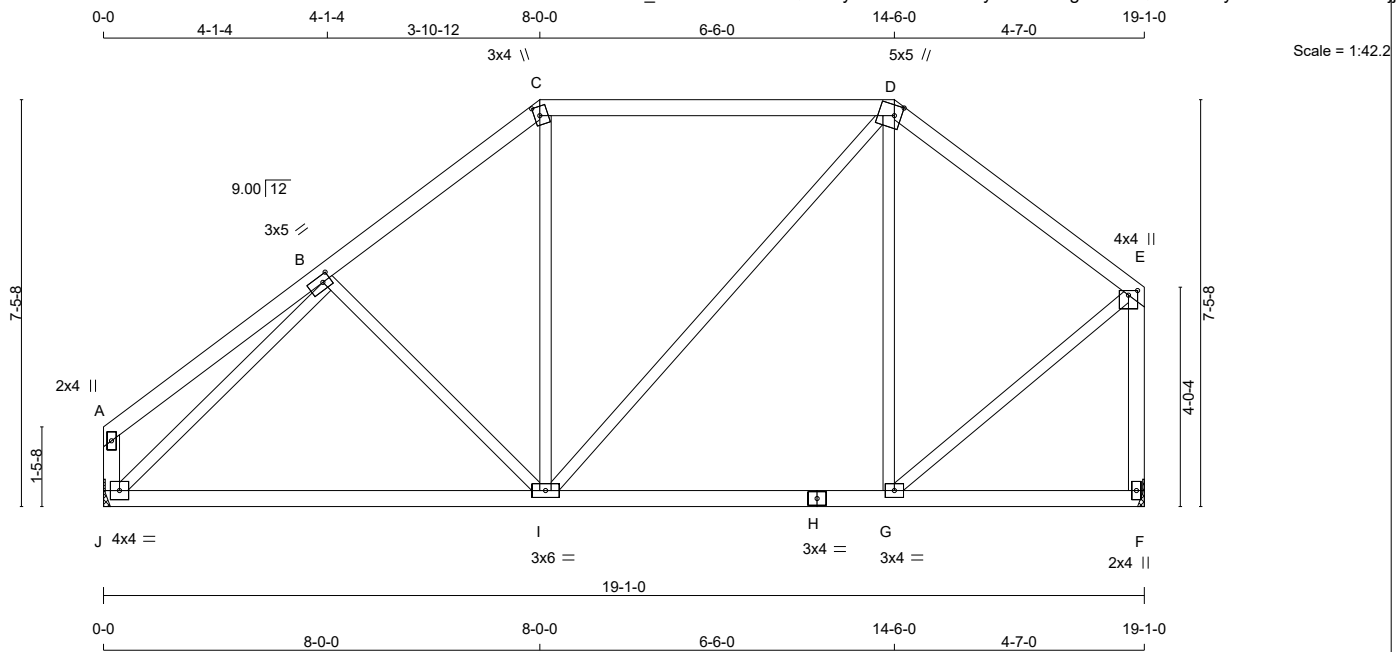

TOTAL WEIGHT = 85 lb [M][F]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
J - A	2x4	DRY	No.2	SPF
F - E	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	2.0	4.0		
B	TMWW-t	MT20	3.0	5.0	1.50	1.75
C	TTW+m	MT20	3.0	4.0	2.00	1.25
D	TTWW+m	MT20	5.0	5.0	2.25	1.50
E	TMVW+p	MT20	4.0	4.0	1.00	2.00
F	BMV1+p	MT20	2.0	4.0		
G	BMWW-t	MT20	3.0	4.0		
H	BS-t	MT20	3.0	4.0		
I	BMWWW-t	MT20	3.0	6.0		
J	BMVW1-t	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	DOWN	IN-SX	IN-SX
J	912	0	0	MECHANICAL
F	912	0	0	MECHANICAL

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT J, F TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
J	641	444 / 0	0 / 0	0 / 0	197 / 0	0 / 0
F	641	444 / 0	0 / 0	0 / 0	197 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 CSI (LC)	MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 CSI (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 22	-77.4	-77.4 0.20 (1)	B-I	-147 / 10	0.09 (1)	
B-C	-780 / 0	-77.4	-77.4 0.16 (1)	I-C	0 / 107	0.04 (4)	
C-D	-607 / 0	-77.4	-77.4 0.42 (1)	I-D	0 / 234	0.05 (1)	
D-E	-569 / 0	-77.4	-77.4 0.21 (1)	G-D	-260 / 0	0.26 (1)	
J-A	-118 / 0	0.0	0.0 0.01 (1)	J-B	-1021 / 0	0.55 (1)	
F-E	-878 / 0	0.0	0.0 0.24 (1)	G-E	0 / 579	0.13 (1)	
J-I	0 / 710	-18.2	-18.2 0.31 (4)				
I-H	0 / 451	-18.2	-18.2 0.30 (4)				
H-G	0 / 451	-18.2	-18.2 0.30 (4)				
G-F	0 / 0	-18.2	-18.2 0.09 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
DL = 3.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.3	PSF	
TOTAL LOAD = 33.6	PSF	

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.64")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.64")
CALCULATED VERT. DEFL.(TL) = L/999 (0.13")

CSI: TC=0.42/1.00 (C-D:1), BC=0.31/1.00 (I-J:4), WB=0.55/1.00 (B-J:1), SSI=0.20/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (G) (INPUT = 0.90)
JSI METAL= 0.30 (B) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN YORK HOMES - GRANELLI HOME CORP - INDIGO 1 ELEV 1	DRWG NO.	PAGE 55 OF 61
NE0618-034	T15	1	1	TRUSS DESC.			

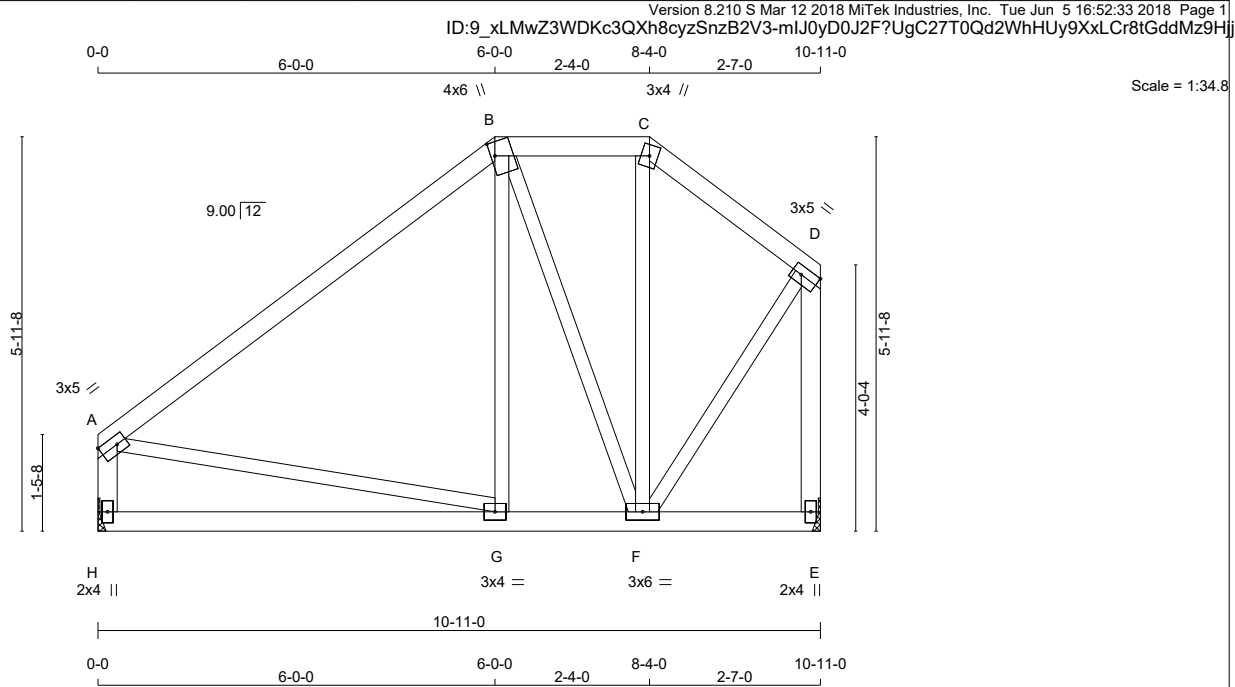

LUMBER			
CHORDS	SIZE	DRY	LUMBER
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
H - A	2x4	DRY	No.2
E - D	2x4	DRY	No.2
H - E	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	3.0	5.0	1.50	Edge
B	TTWW+m	MT20	4.0	6.0	2.50	0.75
C	TTW+m	MT20	3.0	4.0		
D	TMVW-t	MT20	3.0	5.0	1.50	Edge
E	BMV1+p	MT20	2.0	4.0		
F	BMVWW-t	MT20	3.0	6.0		
G	BMVWW-t	MT20	3.0	4.0		
H	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
H	522	0	522	0
E	522	0	522	0

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT H, E TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
H	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
H	367	254 / 0	0 / 0	0 / 0	112 / 0	0 / 0
E	367	254 / 0	0 / 0	0 / 0	112 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	-325 / 0	-77.4	-77.4 0.36 (1)	6.25	G-B	0 / 112	0.04 (4)
B-C	-185 / 0	-77.4	-77.4 0.05 (1)	6.25	B-F	-206 / 0	0.13 (1)
C-D	-234 / 0	-77.4	-77.4 0.07 (1)	6.25	F-C	-49 / 22	0.03 (1)
H-A	-476 / 0	0.0	0.0 0.05 (1)	7.81	A-G	0 / 264	0.06 (1)
E-D	-497 / 0	0.0	0.0 0.13 (1)	7.81	F-D	0 / 317	0.07 (1)
H-G	0 / 0	-18.2	-18.2 0.15 (4)	10.00			
G-F	0 / 261	-18.2	-18.2 0.17 (4)	10.00			
F-E	0 / 0	-18.2	-18.2 0.04 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.3	PSF
TOTAL LOAD	=	33.6	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.36")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.36")
CALCULATED VERT. DEFL.(TL)= L/999 (0.04")

CSI: TC=0.36/1.00 (A-B:1), BC=0.17/1.00 (F-G:4), WB=0.13/1.00 (B-F:1), SI=0.14/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.74 (D) (INPUT = 0.90)
JSI METAL= 0.14 (A) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



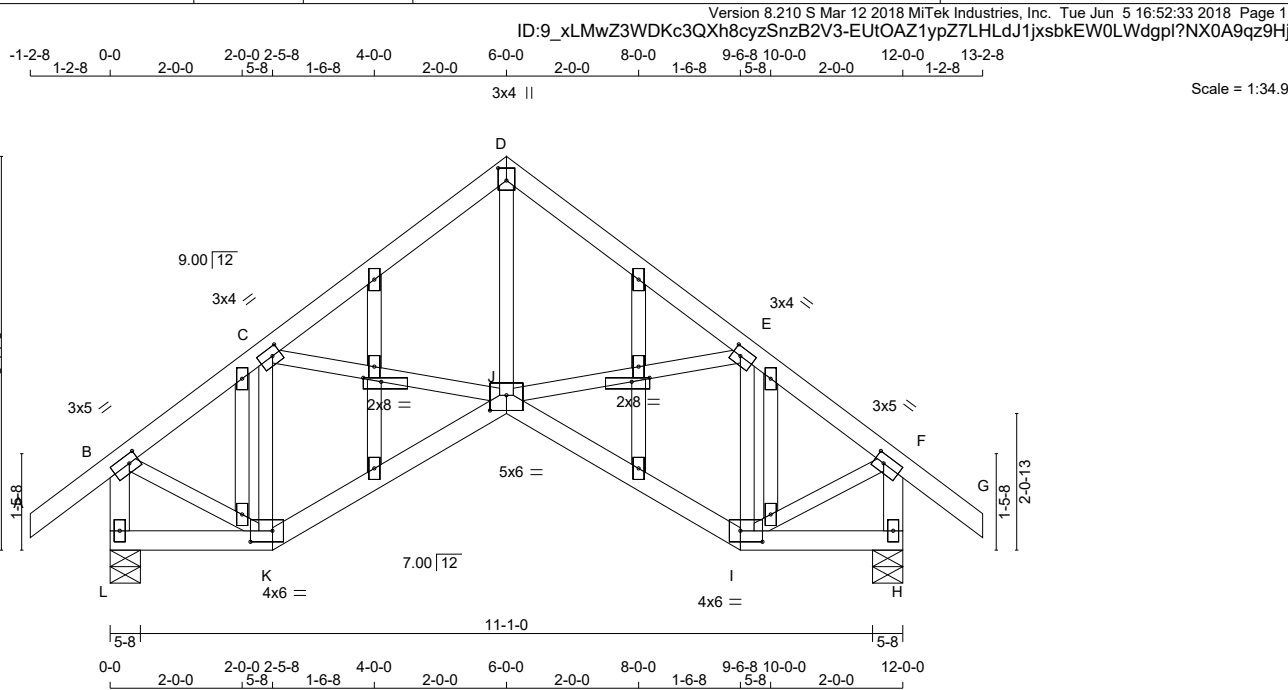

TOTAL WEIGHT = 63 lb

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
L - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - K	2x4	DRY	No.2
K - J	2x4	DRY	No.2
J - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2

ALL WEBS	SIZE	DRY	LUMBER
EXCEPT	2x3	DRY	No.2

ALL GABLE WEBS	SIZE	DRY	LUMBER
2x3	DRY	No.2	

DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2-0-0 OC.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
L	674	0	674	0	5-8	5-8
H	674	0	674	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED		MAX./MIN. COMPONENT REACTIONS			
	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
L	471	340 / 0	0 / 0	0 / 0	131 / 0	0 / 0
H	471	340 / 0	0 / 0	0 / 0	131 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)		
FR-TO		FROM	TO		FR-TO				
A-B	0 / 30	-77.4	-77.4	0.09 (1)	10.00	J-D	0 / 496	0.11 (1)	
B-C	-494 / 0	-77.4	-77.4	0.10 (1)	6.25	J-E	0 / 88	0.02 (1)	
C-D	-622 / 0	-77.4	-77.4	0.12 (1)	6.25	I-E	-369 / 0	0.07 (1)	
D-E	-622 / 0	-77.4	-77.4	0.12 (1)	6.25	C-J	0 / 88	0.02 (1)	
E-F	-494 / 0	-77.4	-77.4	0.10 (1)	6.25	K-C	-369 / 0	0.07 (1)	
F-G	0 / 30	-77.4	-77.4	0.09 (1)	10.00	B-K	0 / 454	0.10 (1)	
L-B	-651 / 0	0.0	0.0	0.07 (1)	7.81	I-F	0 / 454	0.10 (1)	
H-F	-651 / 0	0.0	0.0	0.07 (1)	7.81				
L-K	0 / 0	-18.2	-18.2	0.03 (4)	10.00				
K-J	0 / 464	-18.3	-18.3	0.11 (1)	10.00				
J-I	0 / 464	-18.3	-18.3	0.11 (1)	10.00				
I-H	0 / 0	-18.2	-18.2	0.03 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.40")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.40")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.12/1.00 (D-E:1), BC=0.11/1.00 (I-J:1), WB=0.11/1.00 (D-J:1), SSI=0.10/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.82 (I) (INPUT = 0.90)
JSI METAL= 0.18 (B) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



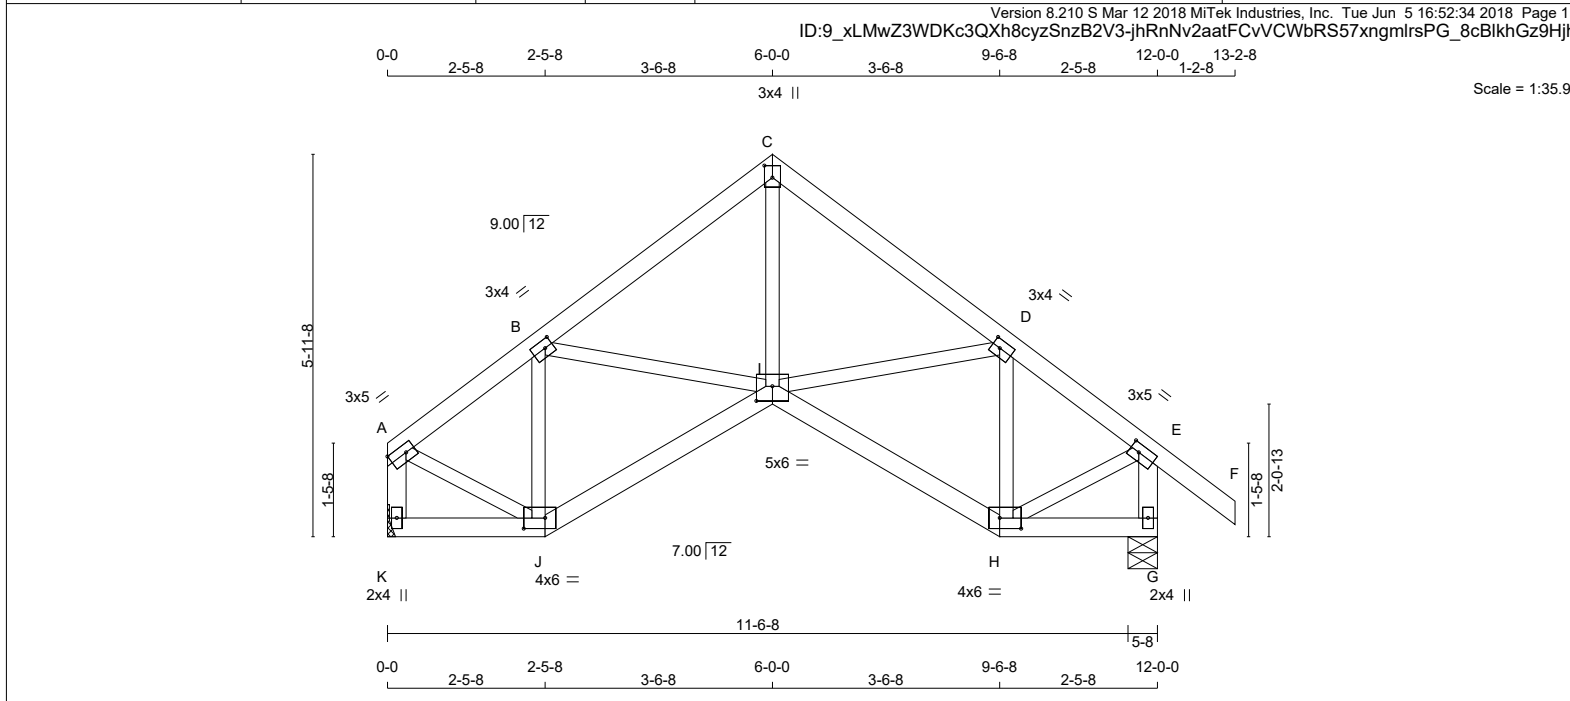

TOTAL WEIGHT = 53 lb [M][F]

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
K - A	2x4	DRY	No.2
G - E	2x4	DRY	No.2
K - J	2x4	DRY	No.2
J - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2
H - G	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	3.0	5.0	1.50	Edge
B	TMWW-t	MT20	3.0	4.0	1.50	1.50
C	TTW+p	MT20	3.0	4.0	2.25	1.50
D	TMWW-t	MT20	3.0	4.0	1.50	1.50
E	TMVW-t	MT20	3.0	5.0	1.50	1.75
G	BMV1+p	MT20	2.0	4.0		
H	BBWW-p	MT20	4.0	6.0	2.00	4.00
I	BBWW-p	MT20	5.0	6.0	2.75	3.00
J	BBWW-p	MT20	4.0	6.0	2.00	4.00
K	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	UPLIFT	IN-SX
K	574	0	0	MECHANICAL
G	674	0	0	5-8

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT K TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	DEAD	SOIL
K	403	279 / 0	0 / 0	0 / 0
G	471	340 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	-494 / 0	-77.4	-77.4 0.10 (1)	I-C	0 / 496	0.11 (1)	
B-C	-622 / 0	-77.4	-77.4 0.12 (1)	I-D	0 / 88	0.02 (1)	
C-D	-622 / 0	-77.4	-77.4 0.12 (1)	H-D	-369 / 0	0.07 (1)	
D-E	-494 / 0	-77.4	-77.4 0.10 (1)	B-I	0 / 88	0.02 (1)	
E-F	0 / 30	-77.4	-77.4 0.09 (1)	J-B	-369 / 0	0.07 (1)	
K-A	-551 / 0	0.0	0.0 0.06 (1)	A-J	0 / 454	0.10 (1)	
G-E	-651 / 0	0.0	0.0 0.07 (1)	H-E	0 / 454	0.10 (1)	
K-J	0 / 0	-18.2	-18.2 0.03 (4)				
J-I	0 / 464	-18.3	-18.3 0.11 (1)				
I-H	0 / 464	-18.3	-18.3 0.11 (1)				
H-G	0 / 0	-18.2	-18.2 0.03 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.3	PSF
TOTAL LOAD		=	33.6	PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.40")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.40")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.12/1.00 (C-D:1), BC=0.11/1.00 (I-J:1), WB=0.11/1.00 (C-I:1), SSI=0.10/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.82 (H) (INPUT = 0.90)
JSI METAL= 0.18 (E) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



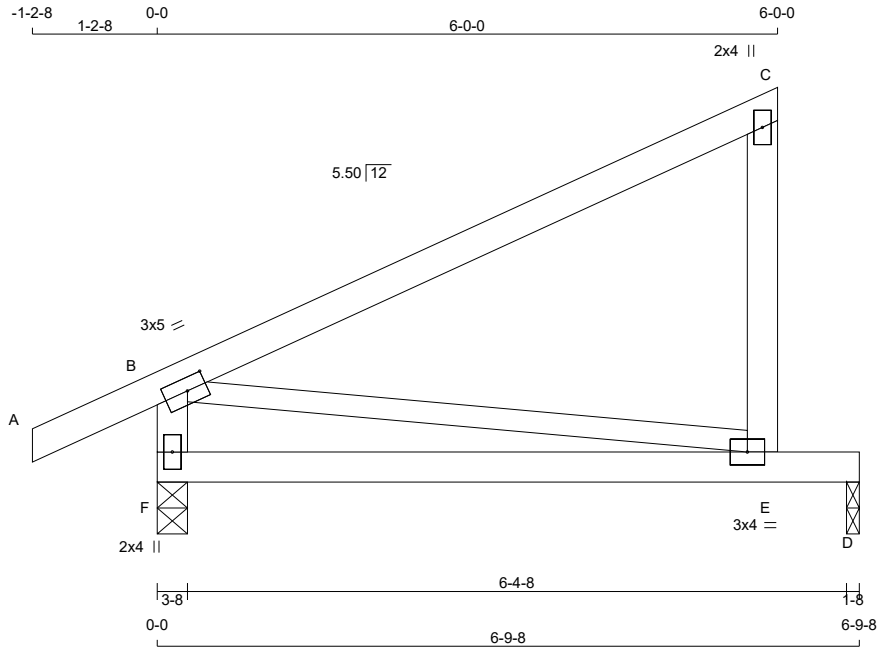

TOTAL WEIGHT = 5 X 26 = 129 lb [M][F]

LUMBER					DESCR.
CHORDS	SIZE	DRY	LUMBER	No.2	
A - C	2x4	DRY	No.2	No.2	SPF
E - C	2x4	DRY	No.2	No.2	SPF
F - B	2x4	DRY	No.2	No.2	SPF
F - D	2x4	DRY	No.2	No.2	SPF
ALL WEBS 2x3 DRY No.2					SPF
DRY: SEASONED LUMBER.					

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	3.0	5.0	1.50 2.25
C	TMV+p	MT20	2.0	4.0	
E	BMVW-t	MT20	3.0	4.0	
F	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	GROSS REACTION	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX
F	419	0	419	0	0	3-8	3-8		
D	267	0	267	0	0	1-8	1-8		

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	292	215 / 0	0 / 0	0 / 0	0 / 0	0 / 0	77 / 0	0 / 0
D	189	123 / 0	0 / 0	0 / 0	0 / 0	0 / 0	65 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 20	-77.4	-77.4 0.09 (1)	10.00	B-E	0 / 0	0.00 (1)
B-C	0 / 0	-77.4	-77.4 0.47 (1)	10.00			
E-C	-232 / 0	0.0	0.0 0.05 (1)	7.81			
F-B	-330 / 0	0.0	0.0 0.03 (1)	7.81			
F-E	0 / 0	-18.2	-18.2 0.30 (1)	10.00			
E-D	0 / 0	-18.2	-18.2 0.28 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.3	PSF
TOTAL LOAD	=	33.6	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.23")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL)= L/360 (0.23")
CALCULATED VERT. DEFL.(TL) = L/401 (0.20")

CSI: TC=0.47/1.00 (B-C:1), BC=0.30/1.00 (E-F:1), WB=0.00/1.00 (B-E:1), SSI=0.21/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.29 (B) (INPUT = 0.90)
JSI METAL= 0.06 (F) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



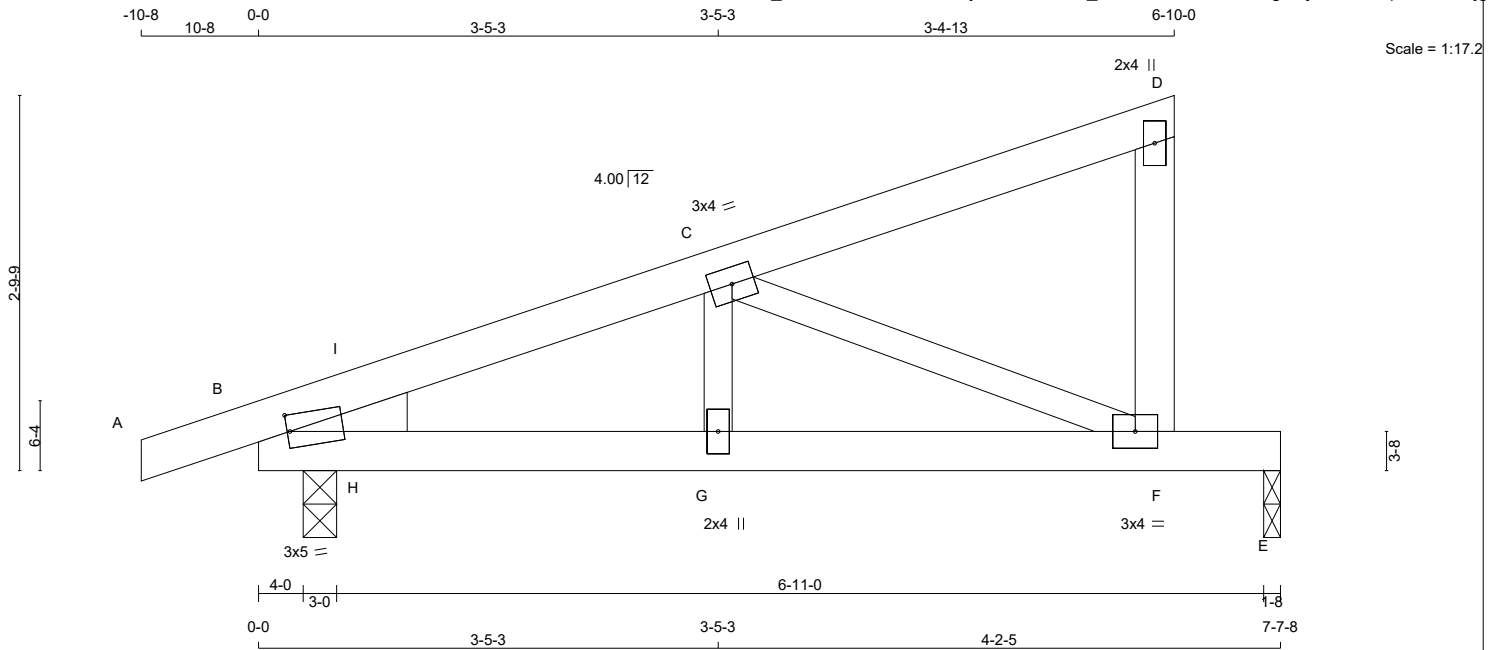

TOTAL WEIGHT = 5 X 25 = 125 lb [M][F]

LUMBER					DESCR.
N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	
A - D	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
B - E	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMBH1-m	MT20	3.0	5.0	1.50	0.25
C	TMWW-t	MT20	3.0	4.0		
D	TMV+p	MT20	2.0	4.0		
F	BMVW-t	MT20	3.0	4.0		
G	BMW+w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG		HEEL WEDGE	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
E	306	0	306	0	0	1-8	1-8		
B	433	0	433	0	0	3-0	3-0	2x4 L	

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
E	217	143 / 0	0 / 0	0 / 0	0 / 0	74 / 0	0 / 0	
B	302	219 / 0	0 / 0	0 / 0	0 / 0	84 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LC1 (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 3	-77.4	-77.4 0.05 (1)	10.00	G-C	0 / 170	0.04 (1)
B-I	-664 / 0	-77.4	-77.4 0.04 (1)	6.25	C-F	-632 / 0	0.14 (1)
I-C	-615 / 0	-77.4	-77.4 0.07 (1)	6.25	H-I	-4 / 23	0.00 (1)
C-D	-6 / 0	-77.4	-77.4 0.10 (1)	10.00			
F-D	-114 / 0	0.0	0.0 0.02 (1)	7.81			
B-H	0 / 586	-18.2	-18.2 0.10 (1)	10.00			
H-G	0 / 586	-18.2	-18.2 0.18 (1)	10.00			
G-F	0 / 586	-18.2	-18.2 0.42 (1)	10.00			
F-E	0 / 0	-18.2	-18.2 0.32 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL	=	23.3 PSF
	DL	=	3.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.3 PSF
TOTAL LOAD		=	33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.25")
CALCULATED VERT. DEFL.(LL) = L/999 (0.04")
ALLOWABLE DEFL.(TL)= L/360 (0.25")
CALCULATED VERT. DEFL.(TL) = L/999 (0.08")

CSI: TC=0.10/1.00 (C-D:1), BC=0.42/1.00 (F-G:1), WB=0.14/1.00 (C-F:1), SSI=0.24/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (F) (INPUT = 0.90)
JSI METAL= 0.22 (F) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.





BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B37579H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-09, section 10.9.4.1.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to **wind** the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-09, section 10.9.4
10. This design is not valid after April 30, 2019.

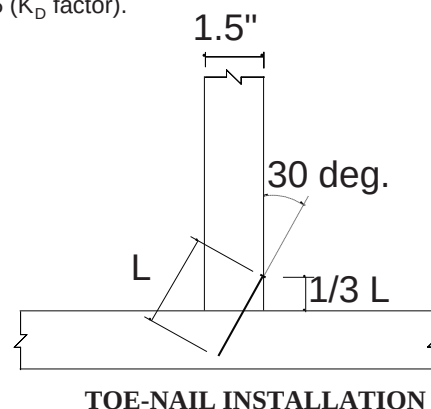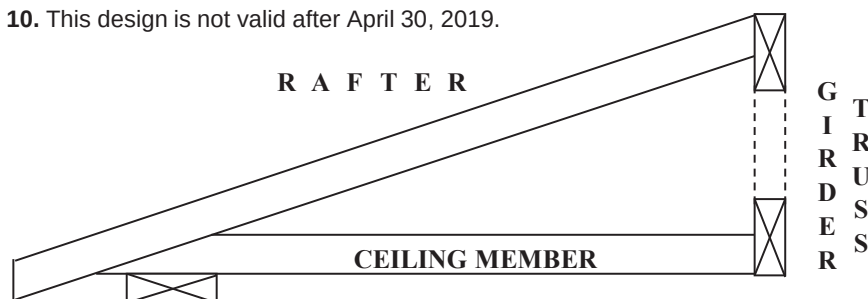

Nail type	Common wire	Common spiral	Common wire
Nail dia. (in)	0.160	0.152	0.144
	(3.5" nail)		(3" and 3.25" nail)
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS		
2X4 SPF	2	2	3
2X4 D. Fir	2	2	2
2X6 SPF	4	4	4
2X6 D. Fir	3	3	3



MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

PEO
Certificate No. 10889485



April 26, 2017

BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B37579H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind or earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-09, section 10.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-09, section 10.9.5
9. This design is not valid after April 30, 2019

Toe-nailing on 2x6 Bearing Plate

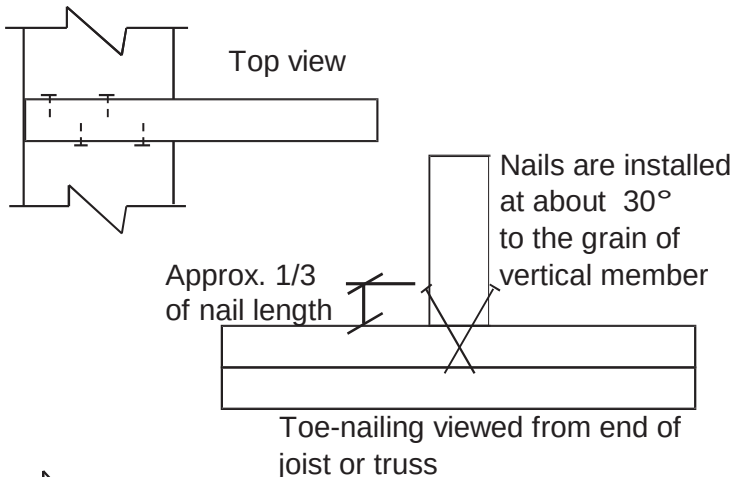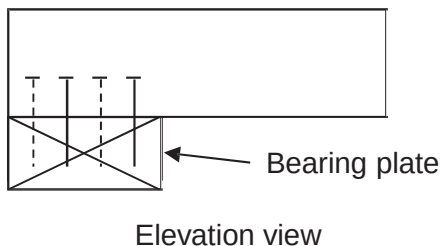

Toe-nailing on 2x4 Bearing Plate

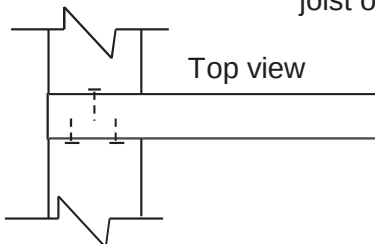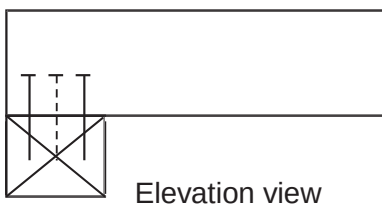

MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

PEO
Certificate No. 10889485



April 26, 2017