

ENGINEERING NOTE PAGE (ENP-1)
PLEASE READ PRIOR TO INSTALLATION

NE0518-223
GREEN YORK HOMES-AMELIA 2 EL 1

RESPONSIBILITIES

THIS DESIGN IS FOR AN INDIVIDUAL BUILDING COMPONENT AND HAS BEEN BASED ON INFORMATION PROVIDED BY THE DESIGN OFFICE OF KOTT LUMBER. THE UNDERSIGNED ENGINEER DISCLAIMS ANY RESPONSIBILITY FOR DAMAGES AS A RESULT OF FAULTY OR INCORRECT INFORMATION, SPECIFICATION AND/OR DESIGNS FURNISHED TO THE ENGINEER. THE UNDERSIGNED ENGINEER IS ONLY RESPONSIBLE FOR THE STRUCTURAL INTEGRITY OF THIS BUILDING COMPONENT FOR THE CONDITIONS AND LOADS SHOWN ON THIS DRAWING. THE STRUCTURAL INTEGRITY OF THE BUILDING AND THE VERIFICATION OF THE DIMENSIONS AND THE DESIGN LOADS USED ARE THE RESPONSIBILITY OF THE BUILDING DESIGNER.

TRUSSES ARE DESIGNED IN CONFORMANCE WITH THE RELEVANT SECTIONS OF THE NATIONAL BUILDING CODE OF CANADA OR THE CANADIAN CODE FOR FARM BUILDINGS, WHICHEVER APPLIES TO THE BUILDING TYPE INDICATED ON THE DRAWING

IT IS THE RESPONSIBILITY OF KOTT LUMBER TO ENSURE THAT TRUSSES ARE MANUFACTURED IN CONFORMANCE WITH THESE DESIGNS AND WITH THE SPECIFICATIONS OUTLINED BELOW. THE UNDERSIGNED ENGINEER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

USE AND OCCUPANCY

- The building is of the type indicated on the drawing

**For conventional framing roof / ceilings
framing shall conform to OBC.9.23**

LOADING

- The truss loading intensity and distribution as well as load transfer mechanism is that indicated on the drawing
- No buildings, trees, parapets or other projections higher than the roof for which the trusses are used are located within a distance less than ten (10) times the difference in height, or five metres (16 ft) whichever is greater, unless the drawing indicates that the snow drifting has been taken into account

HANDLING, INSTALLATION AND BRACING


- The trusses must be handled and installed by a qualified professional as per the supplied document titled *Information for Truss Installers* and the BCSI-B1 and BCSI-B3 Summary Sheets
- The compression chords are laterally braced by continuous rigid diaphragm sheathing or as specified on the drawing
- Temporary and permanent bracing must be installed as indicated on the truss drawing and according to the BCSI-B1 and BCSI-B3 Summary Sheets. Bracing for the lateral stability of the truss is to be provided by the building designer
- **It is recommended that a Professional Engineer's advice be obtained for the bracing of trusses spanning more than 12.37m (40'-7")**

SUPPORTS

- The trusses are to be supported at the bearing points indicated and anchored to the supports where considered necessary by the designer of the overall structure
- Bearing sizes shown are the minimum required to prevent crushing of the truss members and do not necessarily take into account stability of the overall building structure
- Elevation of bearings must be carefully checked and shimmed to alignment for solid bearings
- Adequate wood truss bearing is the responsibility of the building designer.

DIMENSIONS

- Geometry of the truss and dimensions indicated on the drawing are identical to those of the installed truss.

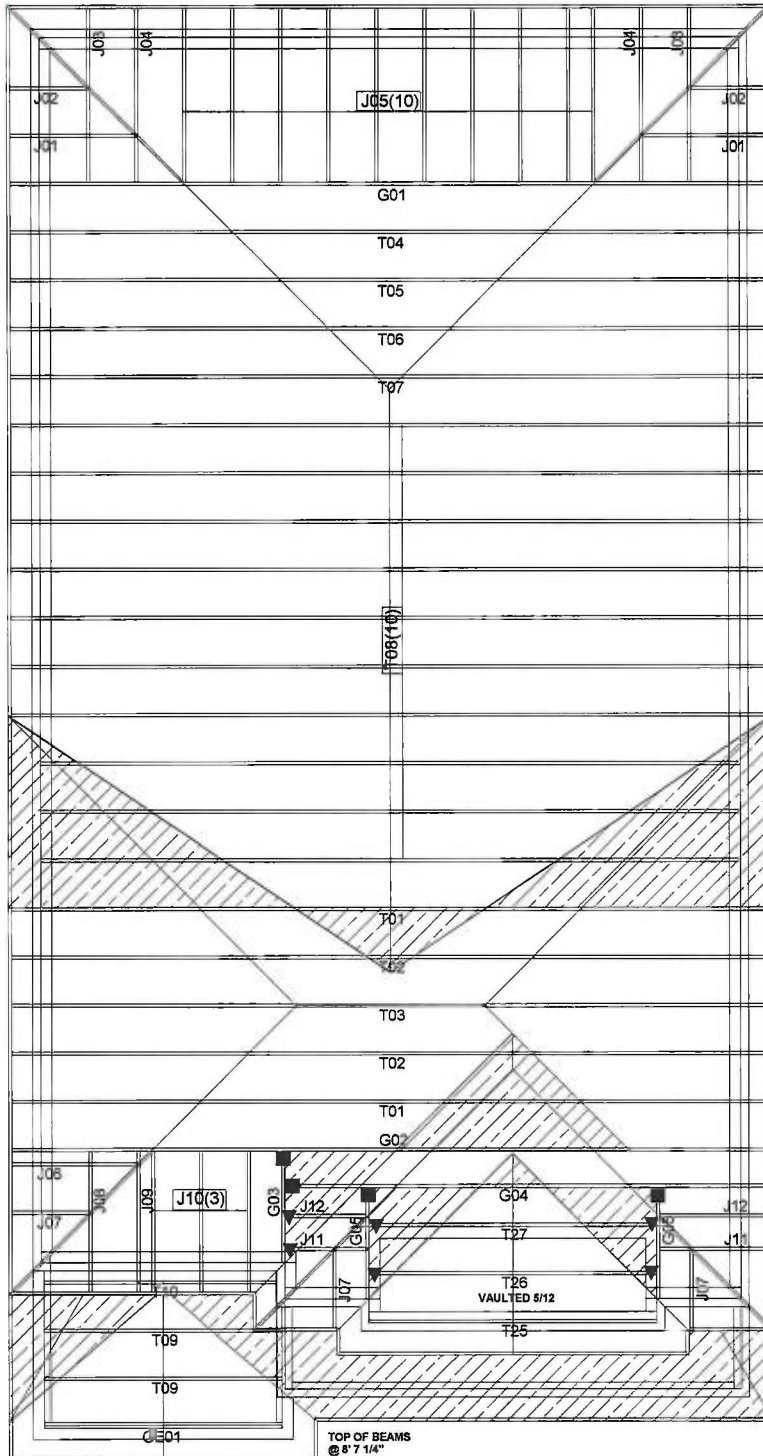


THIS CERTIFICATION IS FOR THE ENGINEERING REVIEW OF STRUCTURAL COMPONENTS SHOWN ON THIS DRAWING AND IS LIMITED TO THE COMPONENTS SUPPLIED BY KOTT LUMBER FOR THE LOADS AND CONDITIONS SHOWN ON THE CALCULATION PAGE OF EACH COMPONENT. THE PLACEMENT OF THESE COMPONENTS ON THIS LAYOUT IS SHOWN FOR REFERENCE ONLY. ROOF TRUSSES MUST BE INSTALLED ACCORDING TO MANUFACTURER'S GUIDELINES AT 24" C/C UNLESS NOTED OTHERWISE. CONVENTIONAL FRAMING SHOWN ON THE LAYOUT MUST BE DESIGNED AND APPROVED BY THE PROJECT ENGINEER. TEMPORARY AND PERMANENT BRACINGS OF THE ROOF AND BUILDING ARE THE RESPONSIBILITY OF THE PROJECT ENGINEER AND TO CONFORM TO BCSI GUIDELINES.



May 31, 2018

NE0518-223

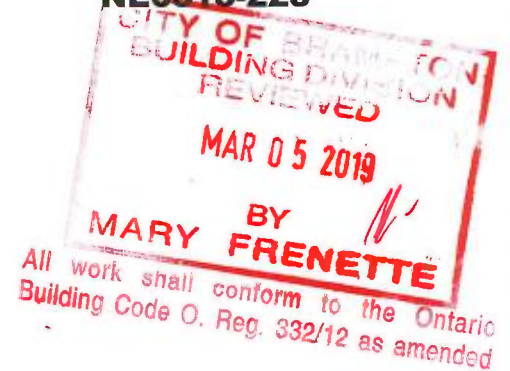

For conventional framing roof / ceilings
framing shall conform to OBC.9.23

The components shown on this layout conform to our recommendations and are adequate to support the design loads required by the Ontario Building Code O. Reg 332/12 as amended and as shown on the engineering calculation page of each component.

The framing direction and girder locations shown on this layout conform to that shown on the architectural drawing.

Deflection: LL = L/360
1.33LL+DL=L/360

Architectural Drawing Info:
Date: MAY 22, 2018
Project number: 17-55
Model: AMELIA 2

19-444464.000.00 RP.



CONVENTIONAL FRAMING BY OTHERS

ALL CONVENTIONAL FRAMING TO CONFORM WITH PART 9 OF THE O.B.C.
ROOF RAFTERS THAT CROSS MEET OVER TRUSSES TO BE 2x4 S.P.F. @ 24" O/C WITH A 2x4 VERTICAL POST TO THE TRUSS UNDERNEATH EACH CROSS POINT. VERTICAL POST LONGER THAN 6' TO HAVE LATERAL BRACING SO THAT THE DISTANCE BETWEEN END POINT AND BETWEEN ROWS OF BRACING DOES NOT EXCEED 6'.

HANGER LEGEND:

- ▼ LUS24 ■ LJS26DS
● HGUS26 X HGUS26-2

SIZE AND LOCATION OF CONVENTIONAL FRAMING IS APPROXIMATE. ALL AREAS MAY NOT BE SHOWN. REFER TO ARCHITECTURAL PLANS FOR DETAILS.

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3 PSF
BOT CH. LL = 0 PSF
DL = 7 PSF
TOTAL LOAD = 33.3 PSF
SPACING = 24" O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 084-09
- TPIC 2011

Model: AMELIA 2 EL 1
Customer: GREEN YORK HOMES
Project: GRANELLI HOMES
Location: BRAMPTON
Date: 5/30/2018 Drawn by: BB


HANGERS NOTES

1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 348.1 lbs FACTORED DOWN AT 23-2-0, AND 348.1 lbs FACTORED DOWN AT 6-0-0 ON TOP CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.90 (I) (INPUT = 0.90)
JSI METAL= 0.94 (Q) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



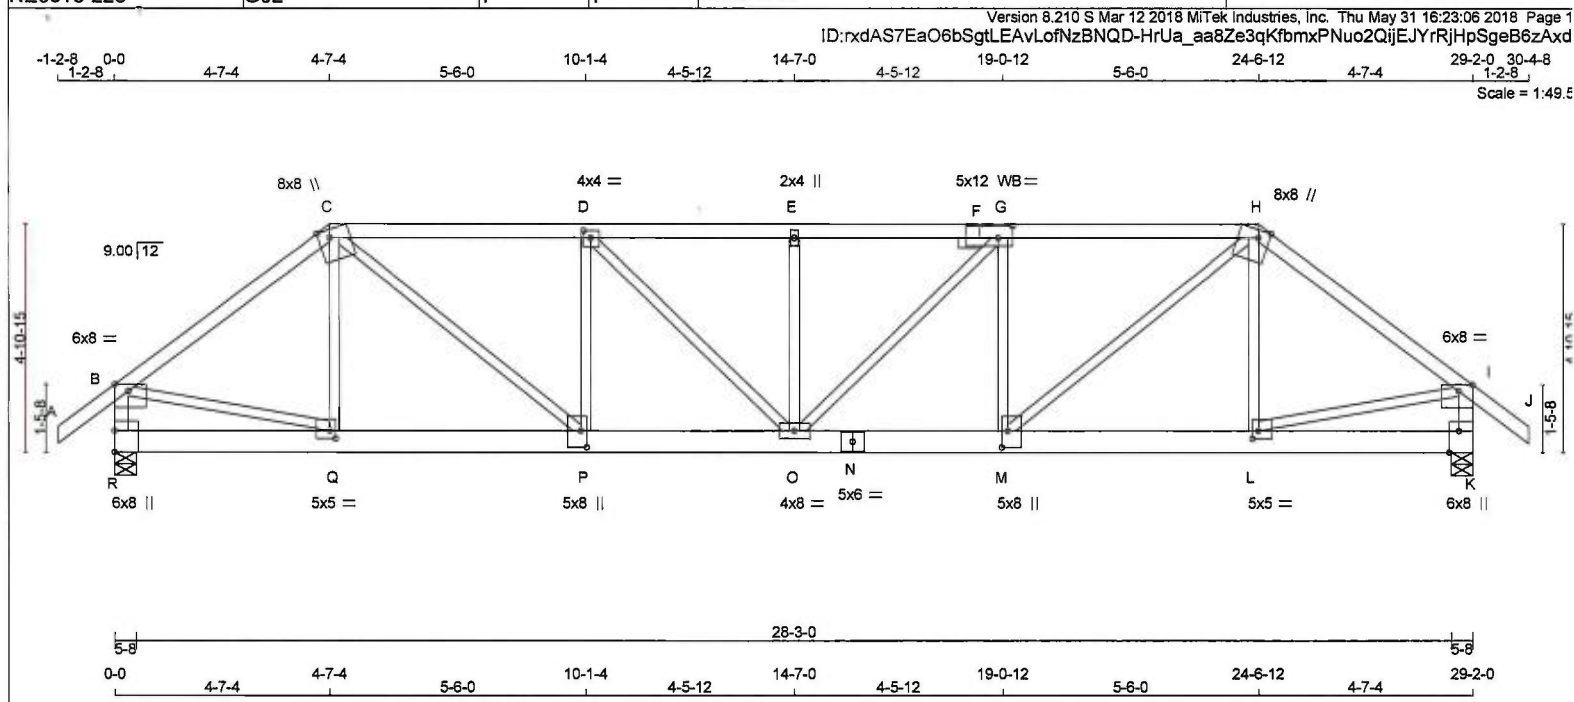

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES				BEARINGS				*** SPECIAL LOADS ANALYSIS ***			
CHORDS	SIZE	LUMBER	DESCR.	FACTORED				GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.			
A - C	2x4	DRY	2100F 1.8E	GROSS REACTION				LOADS WERE DERIVED FROM USER INPUT			
C - F	2x4	DRY	2100F 1.8E	JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
F - H	2x4	DRY	2100F 1.8E	R	2847	0	2847	0	0	5-8	5-8
H - J	2x4	DRY	2100F 1.8E	K	2095	0	2095	0	0	5-8	5-8
R - B	2x4	DRY	No.2	UNFACTORED REACTIONS				SPECIFIED LOADS:			
K - I	2x4	DRY	No.2	1ST LCASE				TOP CH. LL = 23.3 PSF			
R - N	2x6	DRY	No.2	JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
N - K	2x6	DRY	No.2	R	1996	1407 / 0	0 / 0	0 / 0	0 / 0	590 / 0	0 / 0
				K	1468	1041 / 0	0 / 0	0 / 0	0 / 0	427 / 0	0 / 0
ALL WEBS EXCEPT	2x3	DRY	No.2	BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K				BOT CH. LL = 0.0 PSF			
DRY: SEASONED LUMBER.				BRACING				TOTAL LOAD = 33.3 PSF			
				TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.61 FT.				SPACING = 24.0 IN. C/C			
				MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.				LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM			
				ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.				GIRDER TYPE: CPrimeHip			
				LOADING				SIDE SETBACK = 4-7-4			
				TOTAL LOAD CASES: (4)				END SETBACK = 4-7-4			
								END WALL WIDTH = 5-8			
								CORNER FRAMING TYPE: CONVENTIONAL			
								END JACK TYPE: CONVENTIONAL			
								APPLIED TO FRONT SIDE			
								- ADD'T'L LOADS BASED ON 55 % OF GSL.			
								LOADS APPLIED TO FIRST 10-1-4 OF SPAN			
								MEASURED FROM THE LEFT.			
								*** NON STANDARD GIRDER ***			
								ADD'T'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.			
								THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010			
								THIS DESIGN COMPLIES WITH:			
								- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014			
								- CSA 086-09			
								- TPIC 2011			
								(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD			
								ALLOWABLE DEFL.(LL)= L/360 (0.97")			
								CALCULATED VERT. DEFL.(LL)= L/ 999 (0.17")			
								ALLOWABLE DEFL.(TL)= L/360 (0.97")			
								CALCULATED VERT. DEFL.(TL)= L/ 999 (0.29")			
								DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00			
								COMP=1.00 SHEAR=1.00 TENS= 1.00			
								COMPANION LIVE LOAD FACTOR = 0.50			

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

U- N	0 / 3420	-17.5	-17.5	0.49 (1)	10.00		
N- M	0 / 3420	-17.5	-17.5	0.49 (1)	10.00		
M- L	0 / 1824	-17.5	-17.5	0.28 (1)	10.00		
L- K	0 / 0	-17.5	-17.5	0.06 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
C	4-7-4	-184	-184	—	FRONT	VERT	TOTAL
P	10-1-4	-1488	-1468	—	FRONT	VERT	TOTAL

ROOF- LIVE LOAD	
ALLOWABLE DEFL.(LL)=	L/360 (0.97")
CALCULATED VERT. DEFL.(LL) =	L/ 999 (0.17")
ALLOWABLE DEFL.(TL)=	L/360 (0.97")
CALCULATED VERT. DEFL.(TL) =	L/ 999 (0.29")
CSI: TC=0.52/1.00 (C-D:1) , BC=0.68/1.00 (O-P:1) ,	
WB=0.66/1.00 (B-Q:1) , SSi=0.32/1.00 (C-D:1)	
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00	
COMP=1.00 SHEAR=1.00 TENS= 1.00	
COMPANION LIVE LOAD FACTOR = 0.50	

CONTINUED ON PAGE 2



HANGERS NOTES

1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 184.3 lbs FACTORED DOWN AT 4-7-4 ON TOP CHORD, AND 1467.6 lbs FACTORED DOWN AT 10-1-4 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (Q) (INPUT = 0.90)
JSI METAL= 0.77 (Q) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



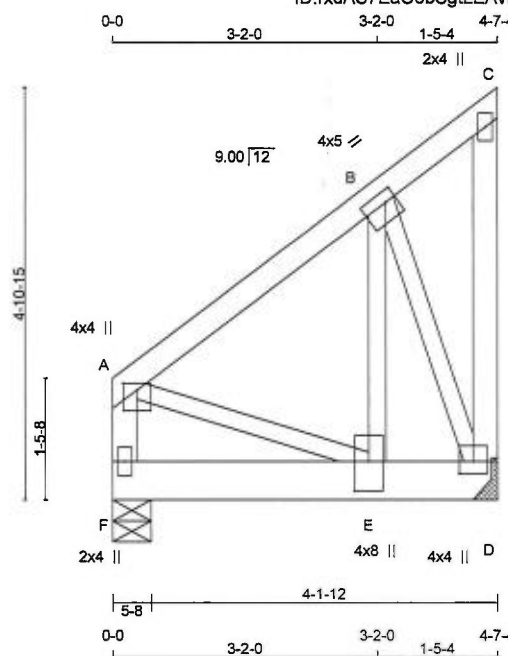

Scale = 1:27.6

TOTAL WEIGHT = 28 lb

LUMBER					DESCR.
N. L. G. A. RULES	CHORDS	SIZE	LUMBER		
F - A	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
D - C	2x4	DRY	No.2	SPF	
F - D	2x6	DRY	No.2	SPF	
ALL WEBS 2x3 DRY					SPF
DRY: SEASONED LUMBER.					

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.00	2.00
B	TMVW+t	MT20	4.0	5.0	1.50	1.50
C	TMV+p	MT20	2.0	4.0		
D	BMVW1+p	MT20	4.0	4.0	1.75	2.00
E	BMVW+t	MT20	4.0	8.0	4.25	2.00
F	BMV1+p	MT20	2.0	4.0		

HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 1765.4 lbs FACTORED DOWN AT 3-2-0 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
F	837	0	837	0	0	5-8	5-8
D	1468	0	1468	0	0	MECHANICAL	

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT D TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
F	588	411 / 0	0 / 0	0 / 0	0 / 0	177 / 0	0 / 0	
D	1030	721 / 0	0 / 0	0 / 0	0 / 0	310 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 MAX (LC)	
FR-TO		FROM TO		FR-TO			
F-A	-692 / 0	0.0	0.0 0.08 (1)	A-E	0 / 571	0.14 (1)	
A-B	-668 / 0	-77.4	-77.4 0.12 (1)	E-B	0 / 1468	0.36 (1)	
B-C	-21 / 0	-77.4	-77.4 0.07 (1)	B-D	-1399 / 0	0.35 (1)	
D-C	-21 / 0	0.0	0.0 0.01 (1)				
F-E	0 / 0	-50.1	-50.1 0.15 (1)				
E-D	0 / 542	-17.5	-17.5 0.22 (1)				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
E	3-2-0	-1765	-1765	—	FRONT	VERT	TOTAL

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL = 23.3 PSF
	DL = 3.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.0 PSF
TOTAL LOAD	= 33.3 PSF

SPACING = 24.0 IN. C/C

GIRDER TYPE: CStd Girder
START DISTANCE = 0-0
START SPAN CARRIED = 3-4-8
END DISTANCE = 3-2-0
END SPAN CARRIED = 3-4-8
END WALL WIDTH = 0-0
APPLIED TO FRONT SIDE OF BOTTOM CHORD.
- ADD'L LOADS BASED ON 55 % OF GSL.

*** NON STANDARD GIRDER ***
ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.12/1.00 (A-B:1), BC=0.22/1.00 (D-E:1), WB=0.36/1.00 (B-E:1), SSI=0.10/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

CONTINUED ON PAGE 2



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.86 (D) (INPUT = 0.90)
JSI METAL= 0.30 (E) (INPUT = 1.00)

LICENSED PROFESSIONAL ENGINEER
N.A. EL-MASRI
N.A. El-Masri
PROVINCE OF ONTARIO
May 31, 2018

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



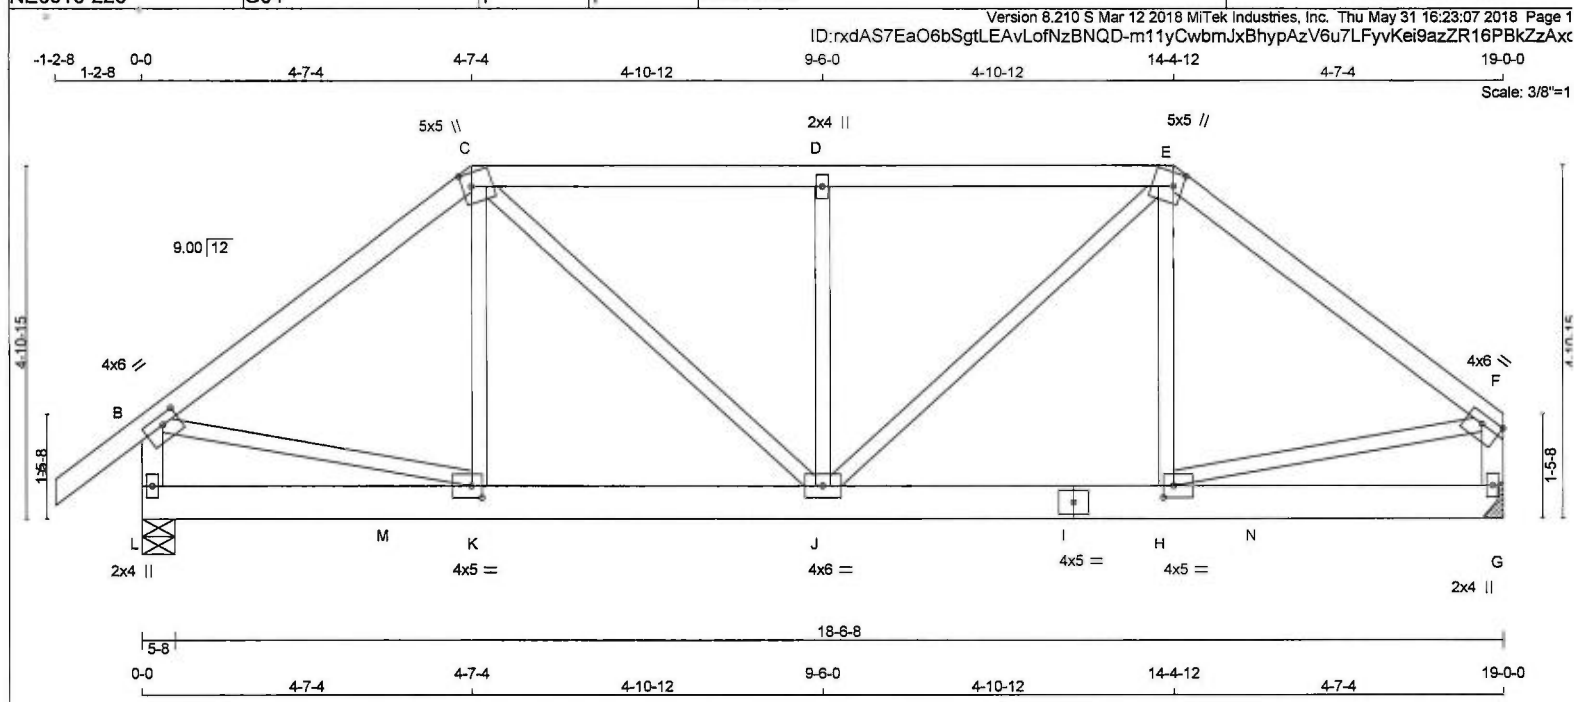

LUMBER			
N. L. G. A.	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
L - B	2x4	DRY	No.2
G - F	2x4	DRY	No.2
L - I	2x6	DRY	No.2
I - G	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	4.0	6.0	1.50 2.75
C	TTWW+m	MT20	5.0	5.0	2.25 1.50
D	TMVW+w	MT20	2.0	4.0	
E	TTWW+m	MT20	5.0	5.0	2.25 1.50
F	TMVW-t	MT20	4.0	6.0	1.50 Edge
G	BMV1+p	MT20	2.0	4.0	
H	BMVW-t	MT20	4.0	5.0	2.00 1.75
I	BS-t	MT20	4.0	5.0	
J	BMVW-t	MT20	4.0	6.0	
K	BMVW-t	MT20	4.0	5.0	2.00 1.75
L	BMV1+p	MT20	2.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES
 1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 864.9 lbs FACTORED DOWN AT 3-5-4, AND 864.9 lbs FACTORED DOWN AT 15-6-12 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.



DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
L	1866	0	1866	0	0	5-8	5-8
G	1766	0	1766	0	0	MECHANICAL	

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT G TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	1308	927 / 0	0 / 0	0 / 0	0 / 0	380 / 0	0 / 0
G	1239	867 / 0	0 / 0	0 / 0	0 / 0	372 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.54 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX CSI (LC)
FR-TO		FROM		FR-TO		FROM	
A-B	0 / 30	-77.4	-77.4 0.10 (1)	K-C	0 / 589	0.15 (1)	
B-C	-1786 / 0	-77.4	-77.4 0.41 (1)	C-J	0 / 233	0.06 (1)	
C-D	-1611 / 0	-77.4	-77.4 0.39 (1)	J-D	-456 / 0	0.16 (1)	
D-E	-1611 / 0	-77.4	-77.4 0.39 (1)	J-E	0 / 233	0.06 (1)	
E-F	-1786 / 0	-77.4	-77.4 0.41 (1)	H-E	0 / 589	0.15 (1)	
L-B	-1671 / 0	0.0	0.0 0.19 (1)	B-K	0 / 1461	0.36 (1)	
G-F	-1571 / 0	0.0	0.0 0.18 (1)	H-F	0 / 1461	0.36 (1)	
L-M	0 / 0	-17.5	-17.5 0.42 (1)				
M-K	0 / 0	-17.5	-17.5 0.42 (1)				
K-J	0 / 1440	-17.5	-17.5 0.46 (1)				
J-I	0 / 1440	-17.5	-17.5 0.46 (1)				
I-H	0 / 1440	-17.5	-17.5 0.46 (1)				
H-N	0 / 0	-17.5	-17.5 0.42 (1)				
N-G	0 / 0	-17.5	-17.5 0.42 (1)				

FACTORED CONCENTRATED LOADS (LBS)				TYPE	
JT	LOC	LC1	MAX-	FACE	DIR.
M	3-5-4	-865	-865	FRONT	VERT
N	15-6-12	-865	-865	FRONT	VERT

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
 GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
 LOADS WERE DERIVED FROM USER INPUT
 NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
 TOP CH. LL = 23.3 PSF
 DL = 3.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.0 PSF
 TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

*** NON STANDARD GIRDER ***
 ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
 - PART 9 OF OBC 2012, BCBC 2012, ABC 2014
 - CSA 086-09
 - TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.63")
 CALCULATED VERT. DEFL.(LL)= L/999 (0.05")
 ALLOWABLE DEFL.(TL)= L/360 (0.63")
 CALCULATED VERT. DEFL.(TL)= L/999 (0.09")

CSI: TC=0.41/1.00 (B-C:1), BC=0.46/1.00 (H-J:1), WB=0.36/1.00 (B-K:1), SSI=0.50/1.00 (K-L:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 822 2284 1656

CONTINUED ON PAGE 2



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (K) (INPUT = 0.90)

JSI METAL= 0.51 (I) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



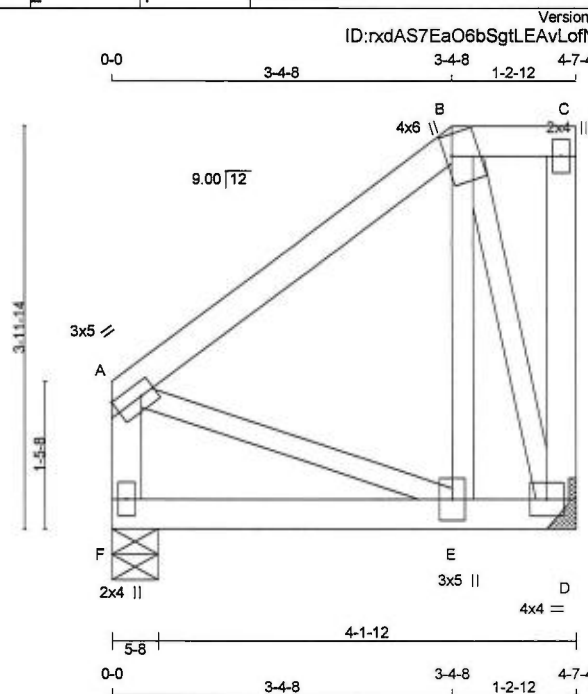

Scale = 1:22.5

TOTAL WEIGHT = $2 \times 25 = 50$ lb

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR
A - B	2x4	DRY	No.2		SPF
B - C	2x4	DRY	No.2		SPF
D - C	2x4	DRY	No.2		SPF
F - A	2x4	DRY	No.2		SPF
F - D	2x4	DRY	No.2		SPF

ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
--------------------	-----	-----	------	-----

DRY: SEASONED LUMBER.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	3.0	5.0	1.50	Edge
B	TTWW+m	MT20	4.0	6.0	2.50	0.75
C	TMV+p	MT20	2.0	4.0		
D	BMVW1-t	MT20	4.0	4.0		
E	BMWW+t	MT20	3.0	5.0		
F	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

HANGERS NOTES

1) SPECIAL HANGER(S) OR CONNECTION(S)
REQUIRED TO SUPPORT CONCENTRATED
LOAD(S) 81.6 lbs FACTORED DOWN AT 3-4-8 ON
TOP CHORD. DESIGN FOR UNSPECIFIED
CONNECTION(S) IS DELEGATED TO THE
BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
D	866	0	866	0	0	MECHANICAL	
F	804	0	804	0	0	5-8	5-8

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT D TO RESIST THE MAX FACTORED REACTIONS

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
D	607	428 / 0	0 / 0	0 / 0	0 / 0	179 / 0	0 / 0
F	565	391 / 0	0 / 0	0 / 0	0 / 0	174 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LOCS MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)		
FR-TO		FROM	TO		FR-TO				
A-B	-342 / 0	-77.4	-77.4	0.17 (1)	6.25	E-B	0 / 817		
B-C	0 / 0	-104.0	-104.0	0.03 (1)	10.00	B-D	-935 / 0		
D-C	-64 / 0	0.0	0.0	0.02 (1)	7.81	A-E	0 / 287		
F-A	-426 / 0	0.0	0.0	0.05 (1)	7.81				
E-E	0 / 0	-260.7	-260.7	0.41 (1)	10.00				
E-D	0 / 296	-260.7	-260.7	0.44 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
1	3-4-8	-82	-82	—	BACK	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.0	PSF
TOTAL LOAD	=	33.3	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A
SLOPE OF 2.00/12 MINIMUM

GIRDER TYPE: CStdGirder
START DISTANCE = 0-0
START SPAN CARRIED = 12-0-0
END DISTANCE = 4-7-4
END SPAN CARRIED = 12-0-0
END WALL WIDTH = 0-0
APPLIED TO FRONT SIDE OF BOTTOM CHORD.
- ADD'L LOADS BASED ON 55 % OF GSL.

GIRDER TYPE: CPrimeHip
LEFT SETBACK = 3-4-8
RIGHT SETBACK = 0-0
END SETBACK = 3-4-8
END WALL WIDTH = 0-0
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
END TO BACK SIDE
- ADD'L LOADS BASED ON 55 % OF GSL

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.04")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/824 (0.07")

CSI: TC=0.17/1.00 (A-B:1), BC=0.44/1.00 (D-E:1),
WB=0.25/1.00 (B-D:1), SS=0.45/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**

CONTINUED ON PAGE 2



TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (E) (INPUT = 0.90)

JSI METAL= 0.22 (E) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



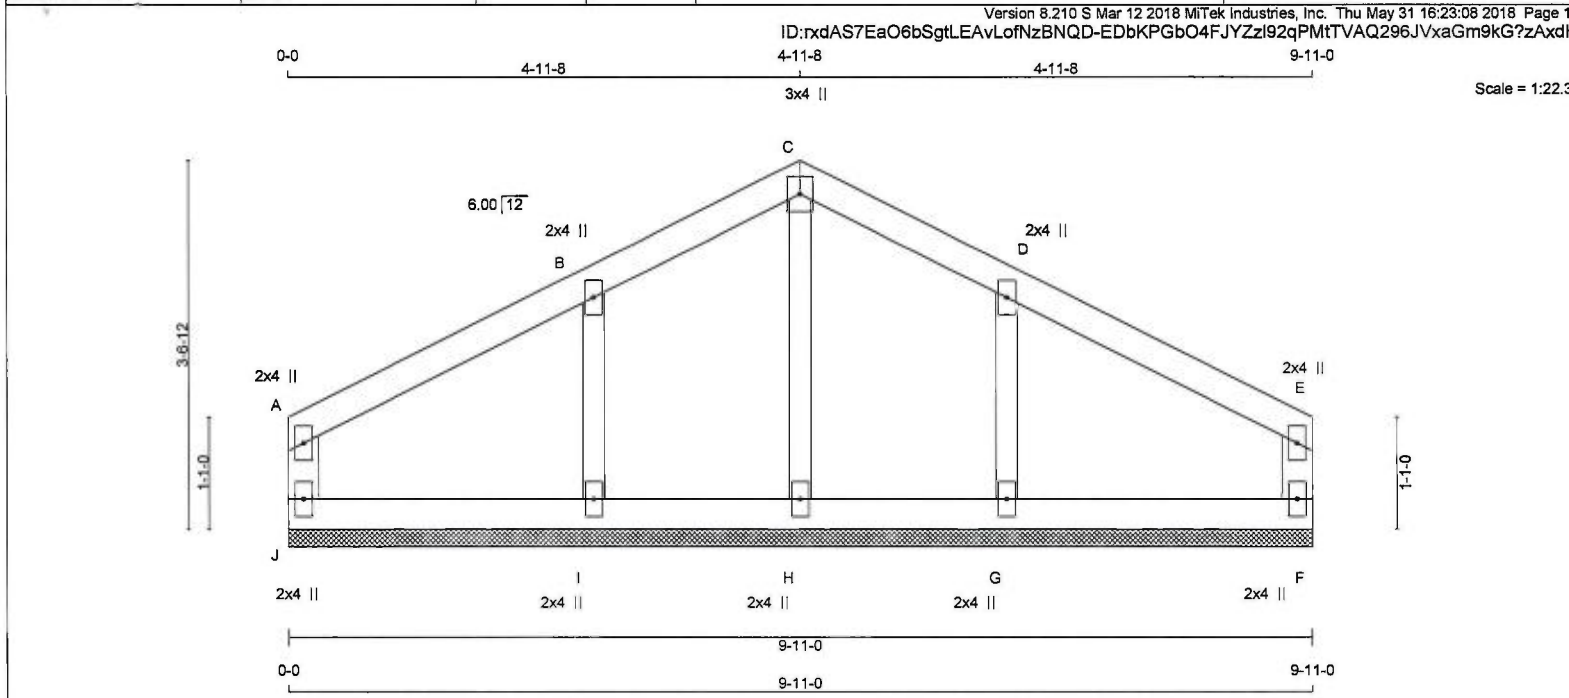


LUMBER		N. L. G. A. RULES		CHORDS		LUMBER		DESCR.	
J - A		2x4		DRY		No.2		SPF	
A - C		2x4		DRY		No.2		SPF	
C - E		2x4		DRY		No.2		SPF	
E - F		2x4		DRY		No.2		SPF	
F - J		2x4		DRY		No.2		SPF	
ALL WEBS		2x3		DRY		No.2		SPF	
ALL GABLE WEBS		2x3		DRY		No.2		SPF	
GABLE STUDS SPACED AT		2-0-0		OC.					
PLATES (table is in inches)		JT TYPE		PLATES		W		LEN Y	
A		TMV+p		MT20		2.0		4.0	
B		TMW+w		MT20		2.0		4.0	
C		TTW+p		MT20		3.0		4.0	
D		TMW+w		MT20		2.0		4.0	
E		TMV+p		MT20		2.0		4.0	
F		BMV1+p		MT20		2.0		4.0	
G, H, I									
G		BMW1+w		MT20		2.0		4.0	
J		BMV1+p		MT20		2.0		4.0	
DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER		BEARINGS		THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.		THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.		BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)	
BRACING		TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.		MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.		ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.		LOADING	
TOTAL LOAD CASES: (4)		CHORDS		MEMB.		WEBS		MEMB.	
MAX. FACTORED		FORCE		VERT. LOAD		MAX. FACTORED		FORCE	
FROM TO		FROM TO		FROM TO		FROM TO		FROM TO	
J-A		-145 / 0		0.0		0.0		0.06 (1)	
A-B		-77 / 0		-77.4		-77.4		0.06 (1)	
B-C		-76 / 0		-77.4		-77.4		0.06 (1)	
C-D		-76 / 0		-77.4		-77.4		0.06 (1)	
D-E		-77 / 0		-77.4		-77.4		0.06 (1)	
E-F		-145 / 0		0.0		0.0		0.06 (1)	
J-I		0 / 69		-17.5		-17.5		0.03 (4)	
I-H		0 / 63		-17.5		-17.5		0.03 (4)	
H-G		0 / 63		-17.5		-17.5		0.03 (4)	
G-F		0 / 69		-17.5		-17.5		0.03 (4)	
DESIGN CRITERIA		SPECIFIED LOADS:		TOP CH.		LL = 23.3		PSF	
				DL = 3.0		PSF			
		BOT CH.		LL = 0.0		PSF			
				DL = 7.0		PSF			
		TOTAL LOAD =		33.3		PSF			
SPACING =		24.0		IN. C/C					
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010		THIS DESIGN COMPLIES WITH:		- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014		- CSA 066-09		- TPIC 2011	
(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD		CSI: TC=0.06/1.00 (A-B:1) , BC=0.03/1.00 (I-J:4) ,		WB=0.03/1.00 (B-I:1) , SSI=0.08/1.00 (A-B:1)		DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10		COMP=1.10 SHEAR=1.10 TENS= 1.10	
COMPANION LIVE LOAD FACTOR = 0.50		TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .		NAIL VALUES		PLATE GRIP(DRY) SHEAR SECTION		(PSI) (PLI) (PLI)	
				MAX MIN MAX MIN MAX MIN		MT20 618 354 1667 822 2284 1656			
PLATE PLACEMENT TOL. = 0.250 inches		PLATE ROTATION TOL. = 5.0 Deg.		JSI GRIP= 0.14 (A) (INPUT = 0.90)		JSI METAL= 0.06 (A) (INPUT = 1.00)			



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



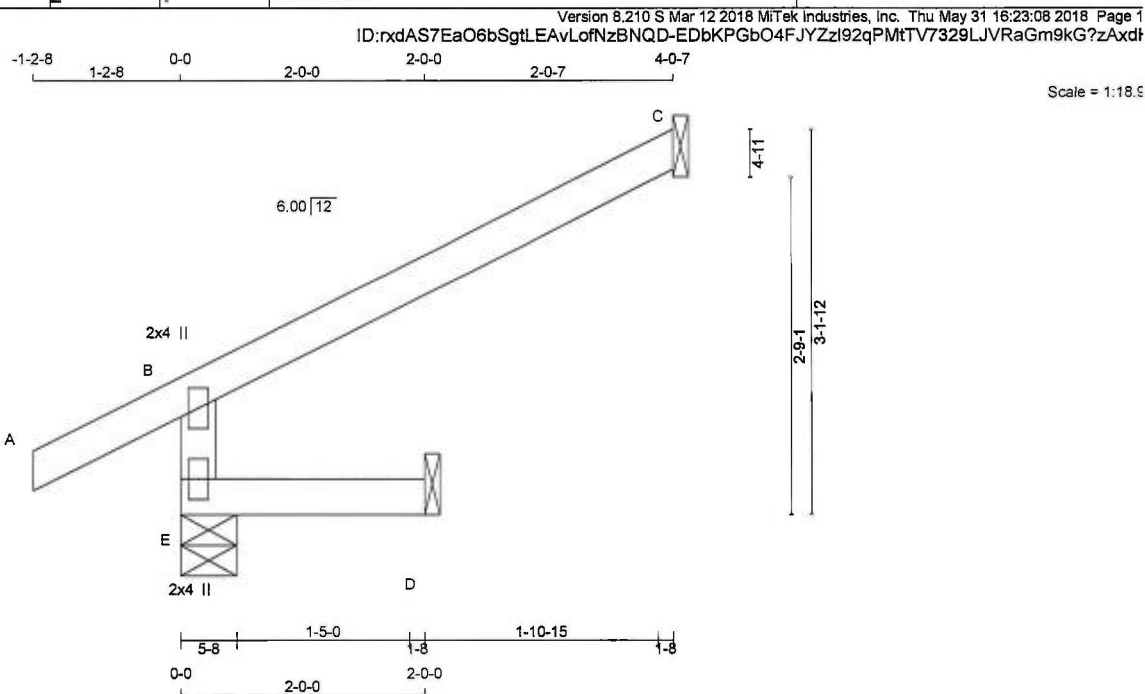

TOTAL WEIGHT = 2 X 10 = 20 lb [M]

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
E	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	REQD BRG IN-SX
E	313	313	5-8	5-8
C	117	117	1-8	1-8
D	16	17	1-8	1-8

SEE MITTEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	215	177 / 0	0 / 0	0 / 0	0 / 0	38 / 0	0 / 0	0 / 0
C	80	71 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0	0 / 0
D	12	0 / 0	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD		MAX. UNBRACED LENGTH FR-TO	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
		FROM	TO				
FR-TO							
E-B	-294 / 0	0.0	0.0	0.01 (4)	7.81		
A-B	0 / 22	-77.4	-77.4	0.09 (1)	10.00		
B-C	-17 / 0	-77.4	-77.4	0.21 (1)	6.25		
E-D	0 / 0	-17.5	-17.5	0.02 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.21/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.14/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



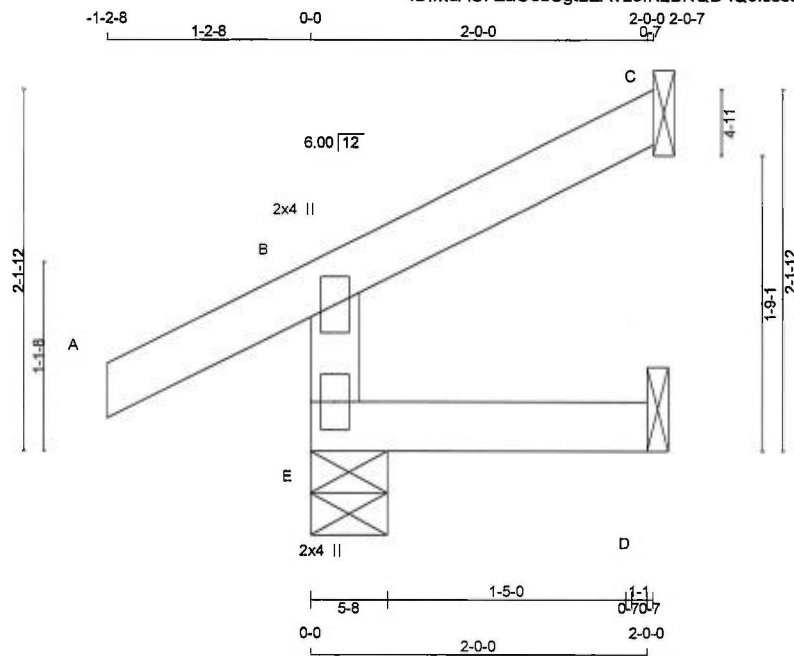

TOTAL WEIGHT = 2 X 7 = 15 lb
[M]

<u>LUMBER</u>			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY No.2	SPF
A - C	2x4	DRY No.2	SPF
E - D	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

	FACTORED		MAXIMUM FACTORED		INPUT	REQRD
	GROSS	REACTION	GROSS	REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
E	216	0	216	0	0	5-8
C	59	0	59	0	0	1-8
D	16	0	17	0	0	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	149	118 / 0	0 / 0	0 / 0	0 / 0	31 / 0	0 / 0
C	40	36 / 0	0 / 0	0 / 0	0 / 0	5 / 0	0 / 0
D	12	0 / 0	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO		FROM TO		FR-TO			
E-B	-197 / 0	0.0	0.0 0.01 (4)	7.81			
A-B	0 / 22	-77.4	-77.4 0.09 (1)	10.00			
B-C	-9 / 0	-77.4	-77.4 0.05 (1)	10.00			
E-D	0 / 0	-17.5	-17.5 0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.0	PSF
TOTAL LOAD	=	33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.00")

CSI: TC=0.09/1.00 (A-B:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SS=0.07/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

NAIL VALUES	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.11 (B) (INPUT = 0.90)
JSI METAL= 0.04 (B) (INPUT = 1.00)



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



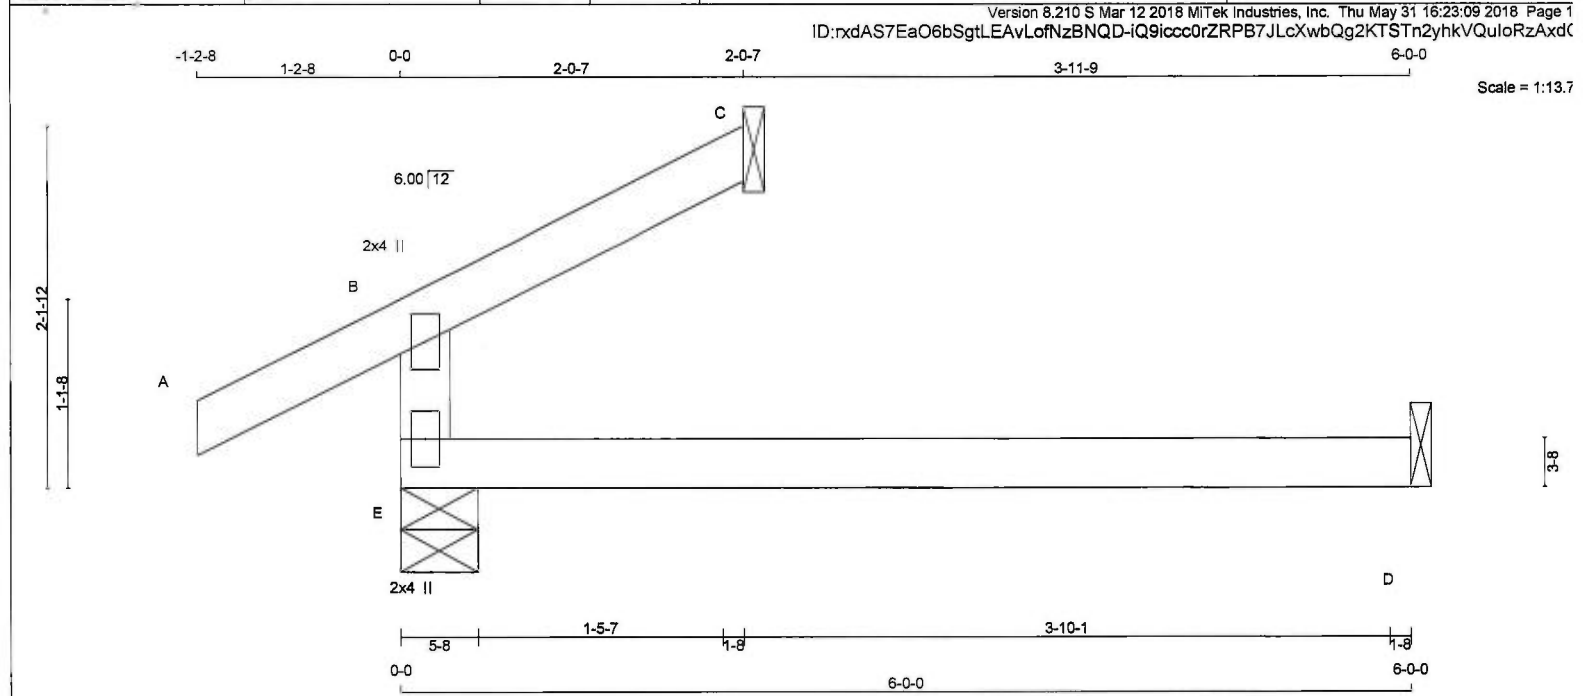

LUMBER					
N. L. G. A.	RULES				
CHORDS	SIZE		LUMBER		DESCR.
E - B	2x4	DRY	No.2		SPF
A - C	2x4	DRY	No.2		SPF
E - D	2x4	DRY	No.2		SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
E	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER						
<u>BEARINGS</u>						
JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
C	258	0	258	0	0	5-8
D	59	0	59	0	0	1-8
E	43	0	48	0	0	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C , D

UNFACTORED REACTIONS							
1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	183	118 / 0	0 / 0	0 / 0	0 / 0	65 / 0	0 / 0
C	40	36 / 0	0 / 0	0 / 0	0 / 0	5 / 0	0 / 0
D	35	0 / 0	0 / 0	0 / 0	0 / 0	35 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	CS1 (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO				FR-TO			
E-B	-197 / 0	0.0	0.0	0.11 (4)	7.81				
A-B	0 / 22	-77.4	-77.4	0.09 (1)	10.00				
B-C	-9 / 0	-77.4	-77.4	0.04 (1)	10.00				
E-D	0 / 0	-17.5	-17.5	0.13 (4)	10.00				

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH.	LL = 23.3 PSF
	DL = 3.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.0 PSF
TOTAL LOAD	= 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT
OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.11/1.00 (B-E:4) , BC=0.13/1.00 (D-E:4) ,
WB=0.00/1.00 (n/a:0) , SS=0.08/1.00 (D-E:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES						
PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.11 (B) (INPUT = 0.90)
JSI METAL= 0.04 (B) (INPUT = 1.00)



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



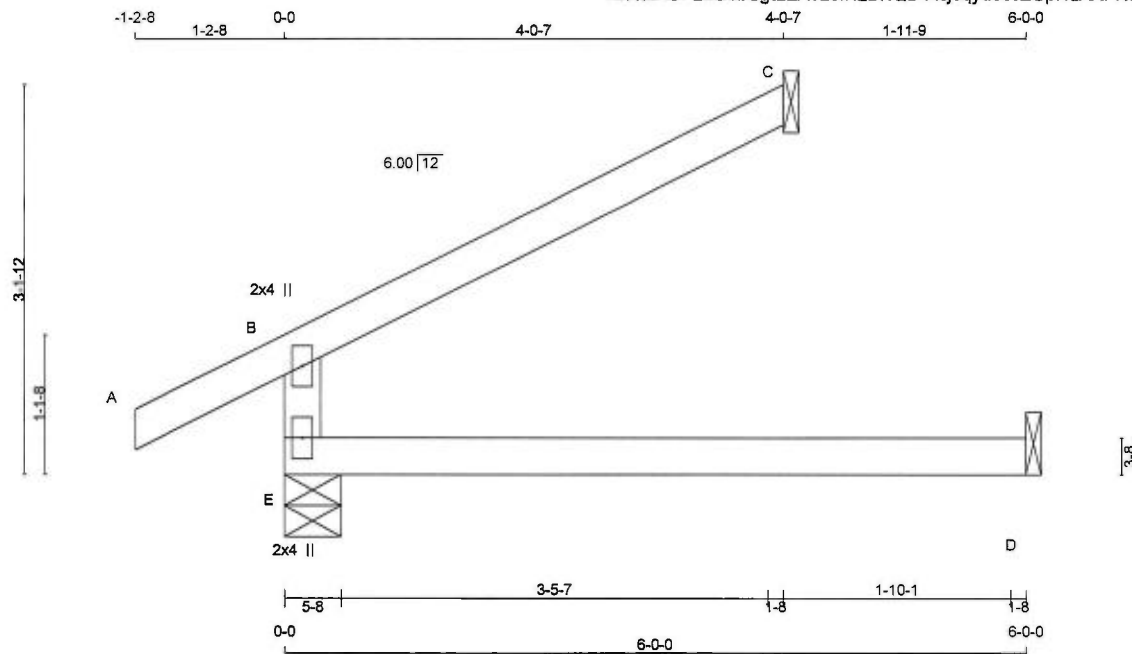

TOTAL WEIGHT = 2 X 14 = 29 lb
[M][F]

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR
E - B	2x4	DRY No.2	SPF
A - C	2x4	DRY No.2	SPF
E - D	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	2.0	4.0	
E	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT IN-SX	IN-SX
E	355	0	355	0	0	5-8
C	117	0	117	0	0	1-8
D	43	0	48	0	0	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	249	177 / 0	0 / 0	0 / 0	0 / 0	72 / 0	0 / 0
C	80	71 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0
D	35	0 / 0	0 / 0	0 / 0	0 / 0	35 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO		FROM TO		FR-TO			
E-B	-294 / 0	0.0	0.0 0.11 (4)	7.81			
A-B	0 / 22	-77.4	-77.4 0.09 (1)	10.00			
B-C	-17 / 0	-77.4	-77.4 0.16 (1)	6.25			
E-D	0 / 0	-17.5	-17.5 0.13 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.0	PSF
TOTAL LOAD	=	33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.03")

CSI: TC=0.16/1.00 (B-C:1), BC=0.13/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SSI=0.14/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



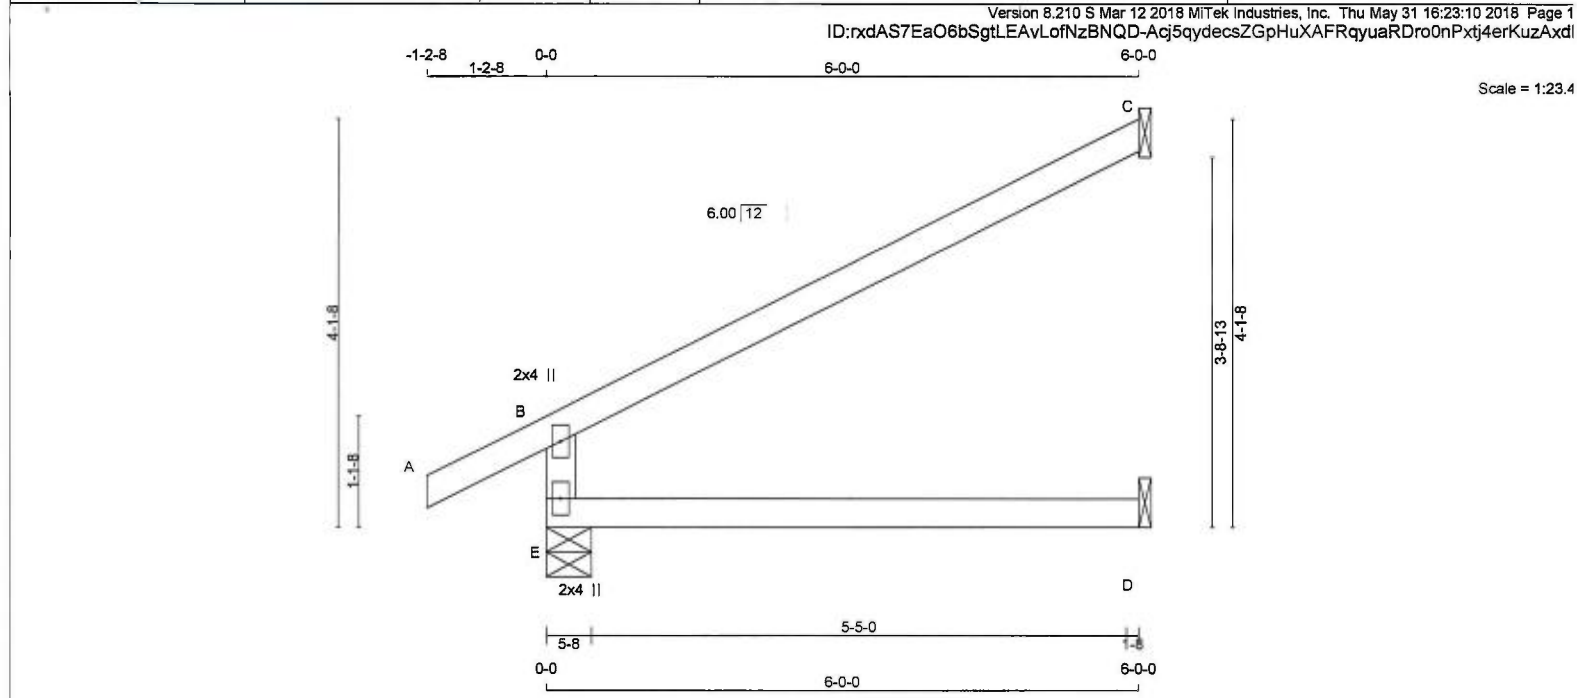

TOTAL WEIGHT = 10 X 17 = 169 LBS
[M]F

LUMBER				
N. L. G. A. RULES	SIZE	LUMBER	DESCR.	SPF
CHORDS				
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	2.0	4.0	
E	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER						
BEARINGS						
JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
E	450	0	450	0	0	5-8
C	174	0	174	0	0	1-8
D	43	0	48	0	0	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C , D

UNFACTORED REACTIONS						
JT	1ST LCASE	MAX /MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
E	314	234 / 0	0 / 0	0 / 0	0 / 0	80 / 0
C	118	105 / 0	0 / 0	0 / 0	0 / 0	14 / 0
D	35	0 / 0	0 / 0	0 / 0	0 / 0	35 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING						
TOTAL LOAD CASES: (4)						
MEMB.	CHORDS			WEBS		
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. FACTORED MEMB. FORCE (LBS)	MAX. FACTORED MEMB. FORCE (LBS)	MAX. FACTORED MEMB. CSI (LC)
FR-TO		FROM TO		UNBRAC LENGTH	FR-TO	
E- B	-389 / 0	0.0	0.0 0.11 (4)	7.81		
A- B	0 / 22	-77.4	-77.4 0.09 (1)	10.00		
B- C	-26 / 0	-77.4	-77.4 0.36 (1)	6.25		
E- D	0 / 0	-17.5	-17.5 0.13 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.03")

CSI: TC=0.36/1.00 (B-C:1) , BC=0.13/1.00 (D-E:4) , WB=0.00/1.00 (n/a:0) , SSI=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.22 (B) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

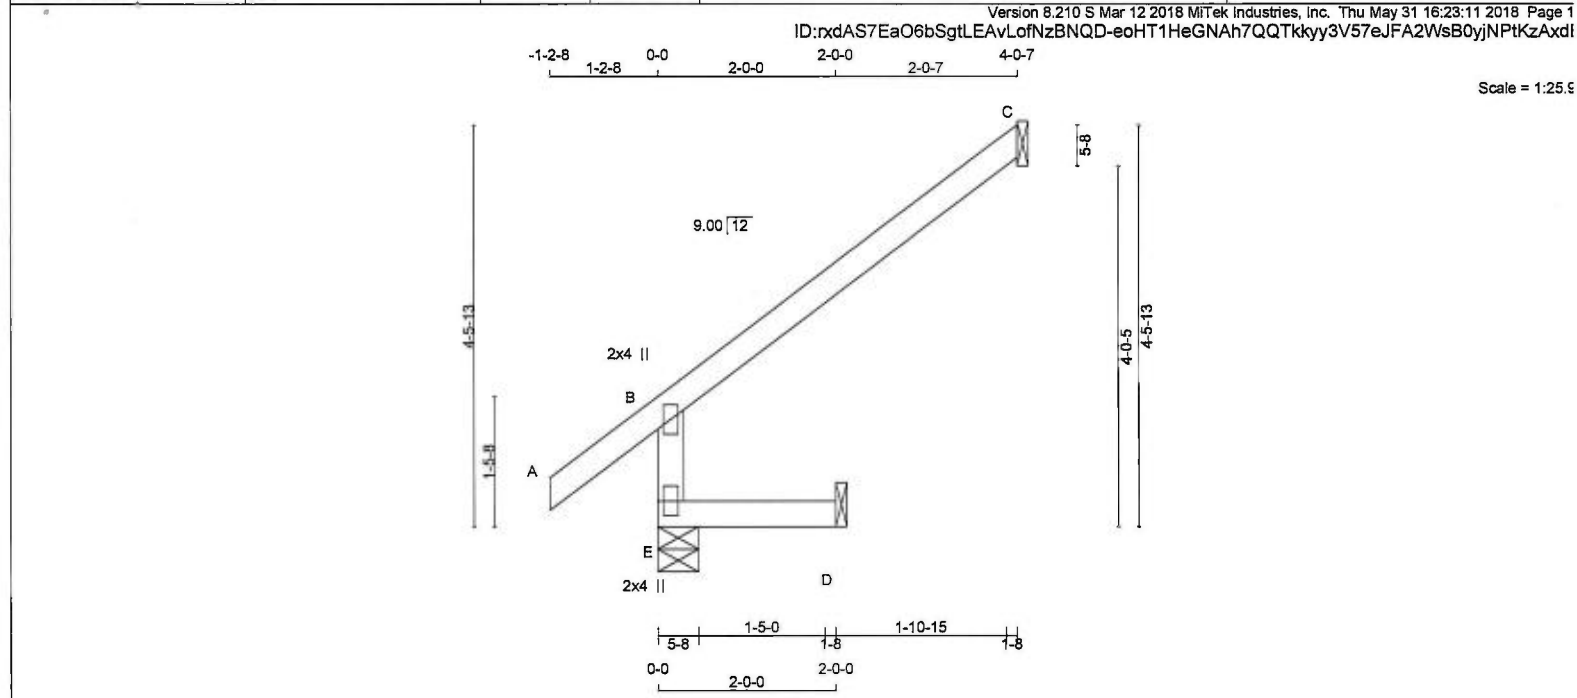

LUMBER							DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										TOTAL WEIGHT = 11 lb	
N. L. G. A. RULES																	[M]	
CHORDS SIZE LUMBER DESCR. SPF																		
E - B 2x4 DRY No.2 SPF																		
A - C 2x4 DRY No.2 SPF																		
E - D 2x4 DRY No.2 SPF																		
DRY: SEASONED LUMBER.																		
SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C , D																		
PLATES (table is in inches)																		
JT TYPE PLATES W LEN Y X																		
B TMV+p MT20 2.0 4.0																		
E BMV1+p MT20 2.0 4.0																		
							UNFACTORED REACTIONS											
							1ST LCASE MAX./MIN. COMPONENT REACTIONS											
							JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL											
							E 216 178 / 0 0 / 0 0 / 0 0 / 0 38 / 0 0 / 0											
							C 80 71 / 0 0 / 0 0 / 0 0 / 0 9 / 0 0 / 0											
							D 13 0 / 0 0 / 0 0 / 0 0 / 0 13 / 0 0 / 0											
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E																		
BRACING																		
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.																		
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.																		
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.																		
LOADING																		
TOTAL LOAD CASES: (4)																		
C H O R D S W E B S																		
MAX. FACTORED MAX. FACTORED																		
MEMB. FORCE VERT. LOAD LC1 MAX MEMB. FORCE MAX																		
(LBS) (PLF) CSI (LC) UNBRAC LENGTH FR-TO (LBS) CSI (LC)																		
FR-TO FROM TO																		
E-B -295 / 0 0.0 0.0 0.01 (4) 7.81																		
A-B 0 / 30 -77.4 -77.4 0.09 (1) 10.00																		
B-C -23 / 0 -77.4 -77.4 0.21 (1) 6.25																		
E-D 0 / 0 -17.5 -17.5 0.02 (4) 10.00																		
DESIGN CRITERIA																		
SPECIFIED LOADS:																		
TOP CH. LL = 23.3 PSF																		
DL = 3.0 PSF																		
BOT CH. LL = 0.0 PSF																		
DL = 7.0 PSF																		
TOTAL LOAD = 33.3 PSF																		
SPACING = 24.0 IN. C/C																		
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010																		
THIS DESIGN COMPLIES WITH:																		
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014																		
- CSA 086-09																		
- TPIC 2011																		
DESIGN ASSUMPTIONS																		
-OVERHANG NOT TO BE ALTERED OR CUT OFF.																		
(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD																		
ALLOWABLE DEFL.(LL)= L/360 (0.19")																		
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")																		
ALLOWABLE DEFL.(TL)= L/360 (0.19")																		
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.00")																		
CSI: TC=0.21/1.00 (B-C:1) , BC=0.02/1.00 (D-E:4) ,																		
WB=0.00/1.00 (n/a:0) , SSI=0.12/1.00 (B-C:1)																		
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10																		
COMP=1.10 SHEAR=1.10 TENS= 1.10																		
COMPANION LIVE LOAD FACTOR = 0.50																		
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .																		
NAIL VALUES																		

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

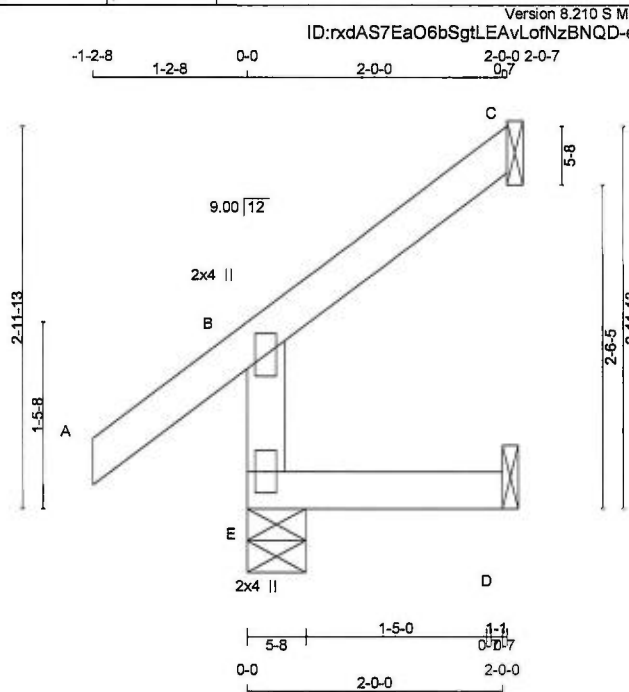

Scale = 1:18.1

TOTAL WEIGHT = 3 X 8 = 25 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	2.0	4.0	
E	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT IN-SX	IN-SX
E	217	0	217	0	0	5-8
C	60	0	60	0	0	1-8
D	16	0	18	0	0	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	150	119 / 0	0 / 0	0 / 0	0 / 0	31 / 0	0 / 0
C	40	36 / 0	0 / 0	0 / 0	0 / 0	5 / 0	0 / 0
D	13	0 / 0	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB. FR-TO	MAX. FORCE (LBS)	FACTORED MAX CSI (LC)
FR-TO		FROM TO					
E-B	-198 / 0	0.0	0.0 0.01 (4)	7.81			
A-B	0 / 30	-77.4	-77.4 0.09 (1)	10.00			
B-C	-12 / 0	-77.4	-77.4 0.05 (1)	6.25			
E-D	0 / 0	-17.5	-17.5 0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.0	PSF
TOTAL LOAD =		33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT
OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= L/999 (0.00")

CSI: TC=0.09/1.00 (A-B:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SS=0.06/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



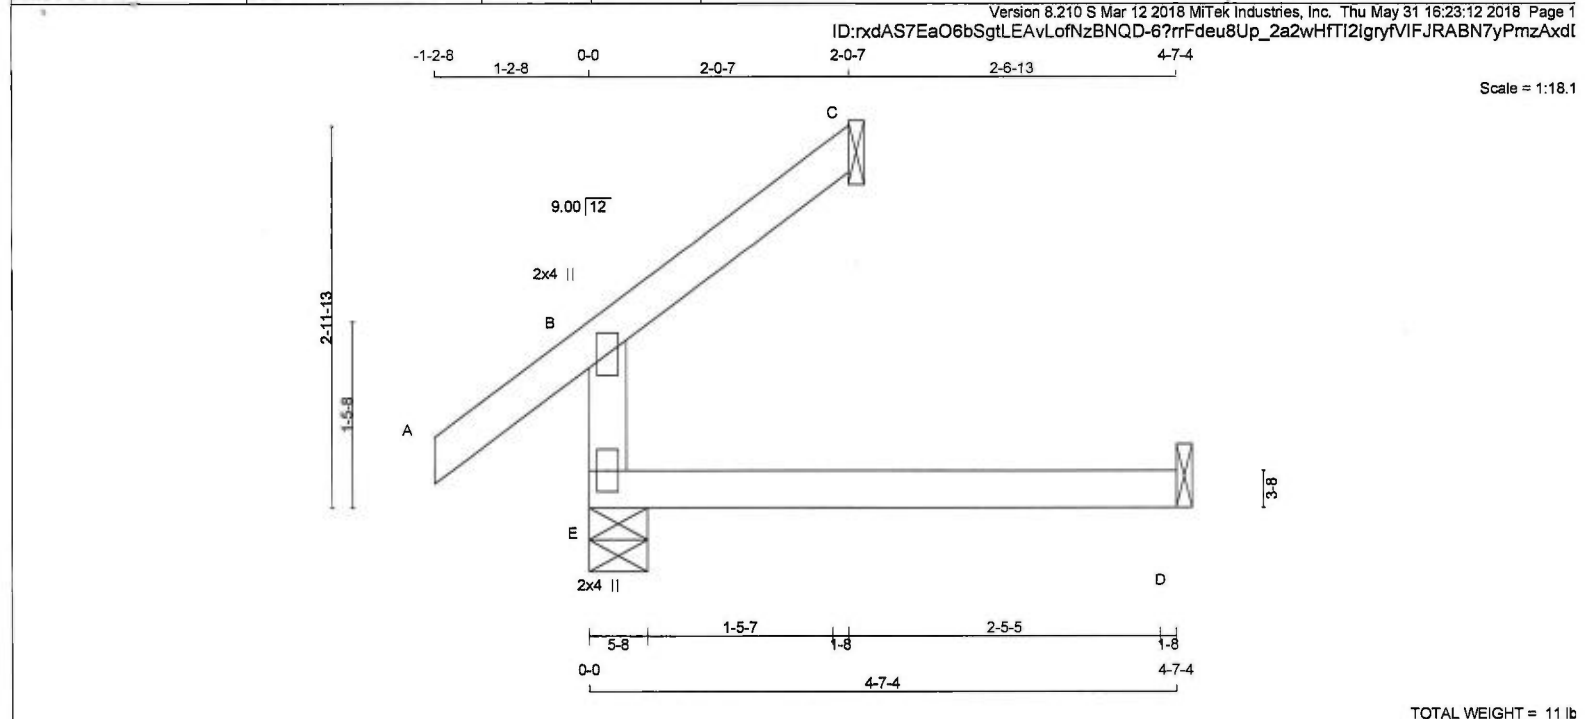

LUMBER

N. L. G. A. RULES

CHORDS SIZE LUMBER DESCR.

E - B 2x4 DRY No.2 SPF

A - C 2x4 DRY No.2 SPF

E - D 2x4 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
E	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
E	244	0	244	0	0	5-8	5-8	
C	60	0	60	0	0	1-8	1-8	
D	34	0	39	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C , D

UNFACTORED REACTIONS

JT	COMBINED	MAX./MIN. COMPONENT REACTIONS					
		1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD
E	172	119 / 0	0 / 0	0 / 0	0 / 0	52 / 0	0 / 0
C	40	36 / 0	0 / 0	0 / 0	0 / 0	5 / 0	0 / 0
D	28	0 / 0	0 / 0	0 / 0	0 / 0	28 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
E-B	-198 / 0	0.0	0.0	0.06 (4)	7.81		
A-B	0 / 30	-77.4	-77.4	0.09 (1)	10.00		
B-C	-12 / 0	-77.4	-77.4	0.05 (1)	6.25		
E-D	0 / 0	-17.5	-17.5	0.08 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.0	PSF
TOTAL LOAD	=	33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.01")

CSI: TC=0.09/1.00 (A-B:1) , BC=0.08/1.00 (D-E:4) ,
WB=0.00/1.00 (n/a:0) , SSI=0.06/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)

LICENSED PROFESSIONAL ENGINEER

N.A. EL-MASRI

PROVINCE OF ONTARIO

May 31, 2018


READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

KOTT



READ ALL NOTES ON THIS PAGE AND ON
 ENGINEERING NOTE PAGE ENP-1. THIS
 NOTE PAGE IS AN INTEGRAL PART OF
 THIS DRAWING AS IT CONTAINS
 SPECIFICATIONS AND CRITERIA USED IN
 THE DESIGN OF THIS COMPONENT.



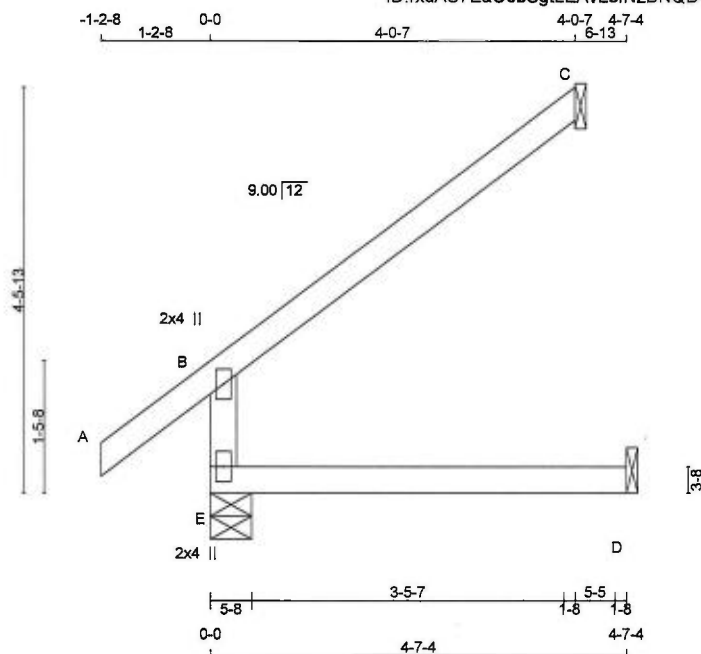

TOTAL WEIGHT = 14 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	2.0	4.0	
E	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

	FACTORED			MAXIMUM FACTORED			INPUT	REQRD
	GROSS REACTION			GROSS REACTION			BRG	BRG
	VERT	HORZ		DOWN	HORZ	UPLIFT	IN-SX	IN-SX
JT	341	0		341	0	0	5-8	5-8
E	117	0		117	0	0	1-8	1-8
C	34	0		39	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
	238	178 / 0	0 / 0	0 / 0	0 / 0	60 / 0	0 / 0
C	80	71 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0
D	28	0 / 0	0 / 0	0 / 0	0 / 0	28 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
E-B	-295 / 0	0.0	0.0	0.06 (4)		7.81	
A-B	0 / 30	-77.4	-77.4	0.09 (1)		10.00	
B-C	-23 / 0	-77.4	-77.4	0.21 (1)		6.25	
E-D	0 / 0	-17.5	-17.5	0.08 (4)		10.00	

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.0	PSF
TOTAL LOAD	=	33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT
OFF

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.01")

CSI: TC=0.21/1.00 (B-C:1), BC=0.08/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SSI=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.20 (B) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



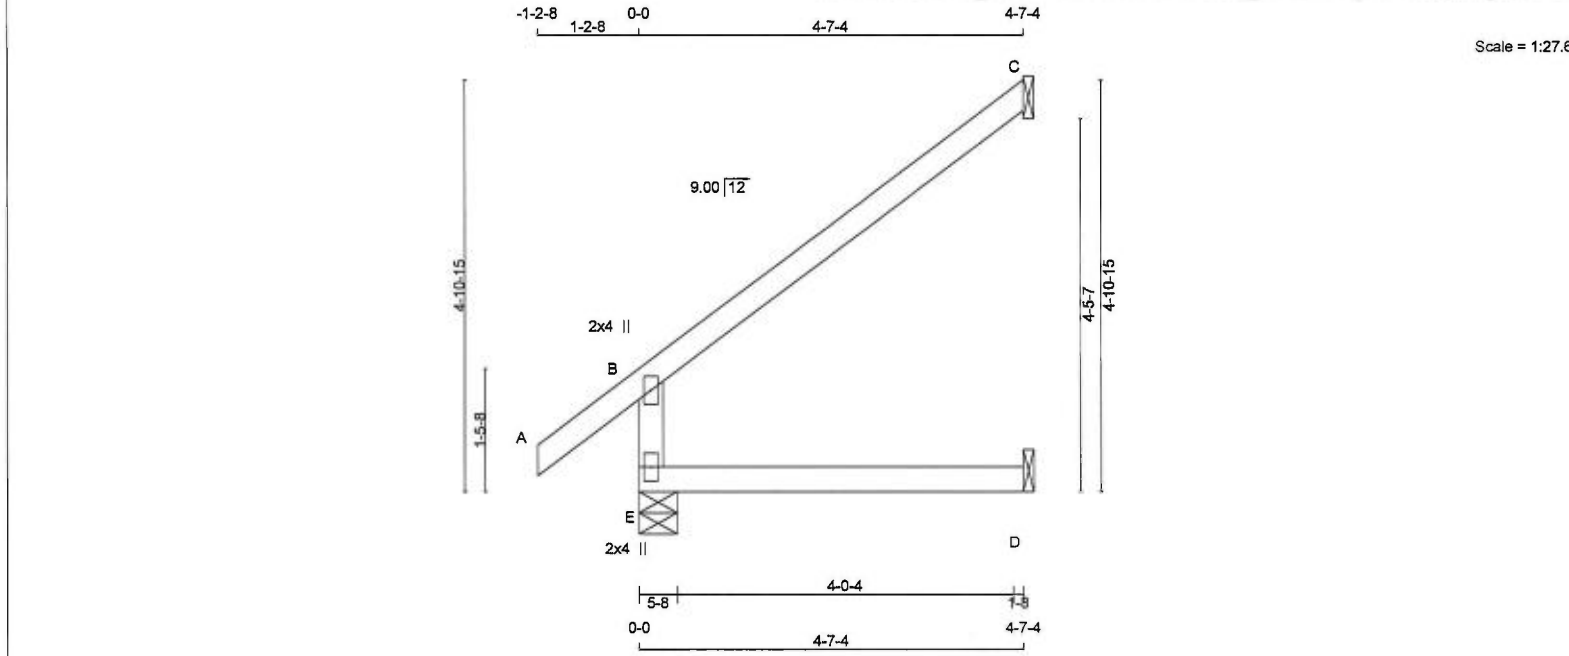

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER E - B 2x4 DRY No.2 A - C 2x4 DRY No.2 E - D 2x4 DRY No.2 DRY: SEASONED LUMBER.		DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 23.3 PSF DL = 3.0 PSF BOT CH. LL = 0.0 PSF DL = 7.0 PSF TOTAL LOAD = 33.3 PSF SPACING = 24.0 IN. C/C THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010 THIS DESIGN COMPLIES WITH: - PART 9 OF OBC 2012, BCBC 2012, ABC 2014 - CSA 086-09 - TPIC 2011 DESIGN ASSUMPTIONS -OVERHANG NOT TO BE ALTERED OR CUT OFF. (55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL)= L/360 (0.19") CALCULATED VERT. DEFL.(LL) = L/999 (0.00") ALLOWABLE DEFL.(TL)= L/360 (0.19") CALCULATED VERT. DEFL.(TL) = L/999 (0.01") CSI: TC=0.28/1.00 (B-C:1), BC=0.08/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.14/1.00 (B-C:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10 COMPANION LIVE LOAD FACTOR = 0.50 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (P.S.I) (P.LI) (P.LI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 822 2284 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.22 (B) (INPUT = 0.90) JSI METAL= 0.08 (B) (INPUT = 1.00)		BEARINGS FACTORED GROSS REACTION JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX E 369 0 369 0 0 5-8 5-8 C 134 0 134 0 0 1-8 1-8 D 34 0 39 0 0 1-8 1-8 SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D UNFACTORED REACTIONS 1ST LCASE MAX/MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL E 256 194 / 0 0 / 0 0 / 0 0 / 0 62 / 0 0 / 0 C 91 80 / 0 0 / 0 0 / 0 0 / 0 10 / 0 0 / 0 D 28 0 / 0 0 / 0 0 / 0 0 / 0 28 / 0 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS WEBS MAX. FACTORED MAX. FACTORED MEMB. FORCE VERT. LOAD LC1 MAX MEMB. FORCE MAX (LBS) (PLF) CSI (LC) UNBRAC LENGTH FR-TO (LBS) CSI (LC) FR-TO FROM TO E-B -323 / 0 0.0 0.0 0.06 (4) 7.81 A-B 0 / 30 -77.4 -77.4 0.09 (1) 10.00 B-C -27 / 0 -77.4 -77.4 0.28 (1) 6.25 E-D 0 / 0 -17.5 -17.5 0.08 (4) 10.00		TOTAL WEIGHT = 3 X 15 = 45 lb [M]	
---	--	--	--	---	--	--	--

LICENSED PROFESSIONAL ENGINEER

N.A. EL-MASRI


PROVINCIAL REGISTERED

PROVINCE OF ONTARIO


May 31, 2018

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



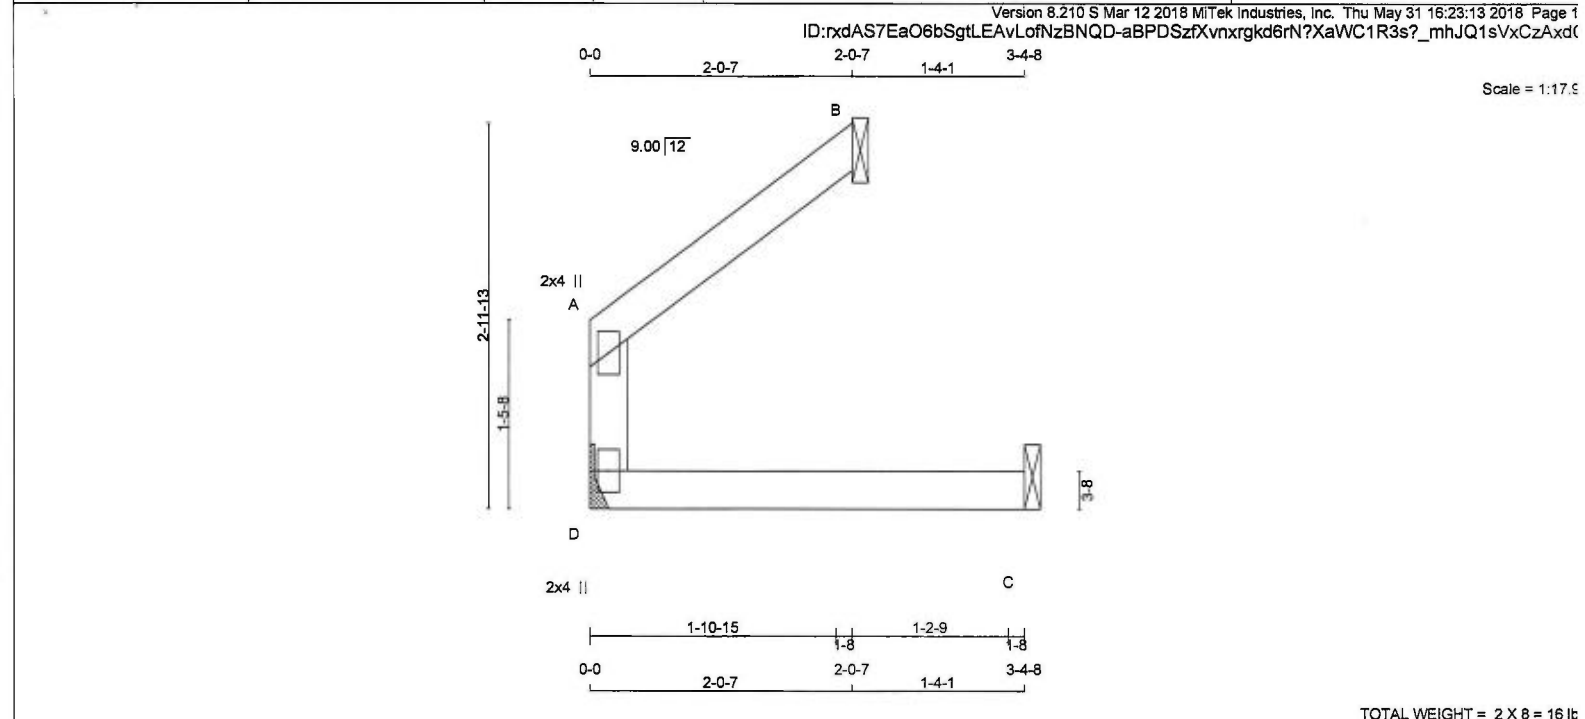

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. SPF D - A 2x4 DRY No.2 SPF A - B 2x4 DRY No.2 SPF D - C 2x4 DRY No.2 SPF DRY: SEASONED LUMBER.					PLATES (table is in inches) JT TYPE PLATES W LEN Y X A TMV+p MT20 2.0 4.0 D BMV1+p MT20 2.0 4.0					DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 23.3 PSF DL = 3.0 PSF BOT CH. LL = 0.0 PSF DL = 7.0 PSF TOTAL LOAD = 33.3 PSF SPACING = 24.0 IN. C/C THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010 THIS DESIGN COMPLIES WITH: - PART 9 OF OBC 2012, CBC 2012, ABC 2014 - CSA 086-09 - TPIC 2011 (55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL)= L/360 (0.19") CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00") ALLOWABLE DEFL.(TL)= L/360 (0.19") CALCULATED VERT. DEFL.(TL) = L/ 999 (0.01") CSI: TC=0.05/1.00 (A-B:1), BC=0.05/1.00 (C-D:4), WB=0.00/1.00 (n/a:0), SSI=0.05/1.00 (A-B:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10 COMPANION LIVE LOAD FACTOR = 0.50 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 822 2284 1656 PLATE PLACEMENT TOL = 0.250 inches PLATE ROTATION TOL = 5.0 Deg. JSI GRIP= 0.05 (A) (INPUT = 0.90) JSI METAL= 0.02 (A) (INPUT = 1.00)				
DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED GROSS REACTION MAXIMUM FACTORED GROSS REACTION INPUT REQRD JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX D 109 0 109 0 0 MECHANICAL B 78 0 78 0 0 1-8 1-8 C 30 0 30 0 0 1-8 1-8 A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT D TO RESIST THE MAX FACTORED REACTIONS. SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) B , C UNFACTORED REACTIONS 1ST LCASE MAX./MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL D 77 49 / 0 0 / 0 0 / 0 0 / 0 28 / 0 0 / 0 B 53 44 / 0 0 / 0 0 / 0 0 / 0 9 / 0 0 / 0 C 24 2 / 0 0 / 0 0 / 0 0 / 0 22 / 0 0 / 0 BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS WEBS MAX. FACTORED MAX. FACTORED MAX. FACTORED MEMB. FORCE VERT. LOAD LC1 MAX MEMB. FORCE MAX (LBS) (PLF) CSI (LC) UNBRAC LENGTH FR-TO (LBS) CSI (LC) FR-TO FROM TO D-A -80 / 0 0.0 0.0 0.02 (4) 7.81 A-B 0 / 3 -77.4 -77.4 0.05 (1) 10.00 D-C 0 / 0 -17.5 -17.5 0.05 (4) 10.00										READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.				

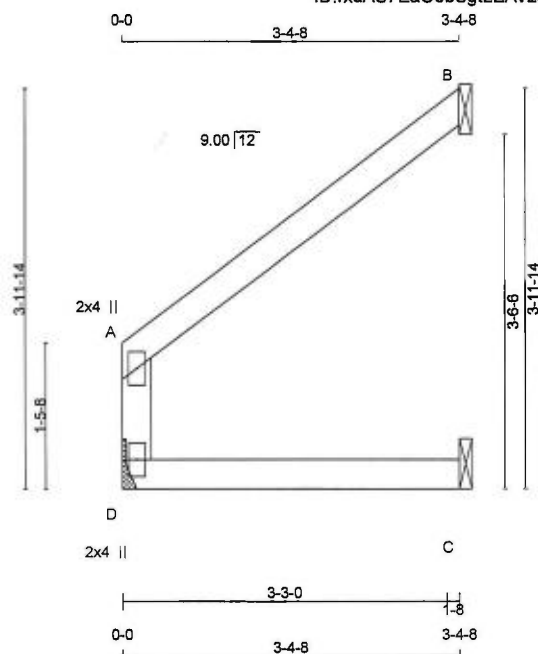

Scale = 1:23.1

TOTAL WEIGHT = 2 X 10 = 20 lb [M]F

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
D - A	2x4	DRY	No.2	SPF
A - B	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMV+p	MT20	2.0	4.0	
D	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
D	160	0	160	0	0	MECHANICAL
B	120	0	120	0	0	1-8
C	40	0	40	0	0	1-8

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT D TO RESIST THE MAX FACTORED REACTIONS.

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS

JT	COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
D	112	79 / 0	0 / 0	0 / 0	0 / 0	34 / 0	0 / 0
B	82	71 / 0	0 / 0	0 / 0	0 / 0	11 / 0	0 / 0
C	30	8 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. MEMB. FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO	UNBRAC LENGTH FR-TO	
D-A	-141 / 0	0.0	0.0	0.04 (1)
A-B	-6 / 0	-77.4	-77.4	0.12 (1)
D-C	0 / 0	-17.5	-17.5	0.06 (1)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.12/1.00 (A-B:1), BC=0.06/1.00 (C-D:1),
WB=0.00/1.00 (n/a:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (A) (INPUT = 0.90)
JSI METAL= 0.04 (A) (INPUT = 1.00)




READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu May 31 16:23:14 2018 Page 1

ID: rxdAS7EaO6bSgtLEAvLofNzBNQD-2NzbJg9g53hHuCJP4Wm7jI7LT8Bj44Tehc3UfzAxdI


Scale = 1:49.7

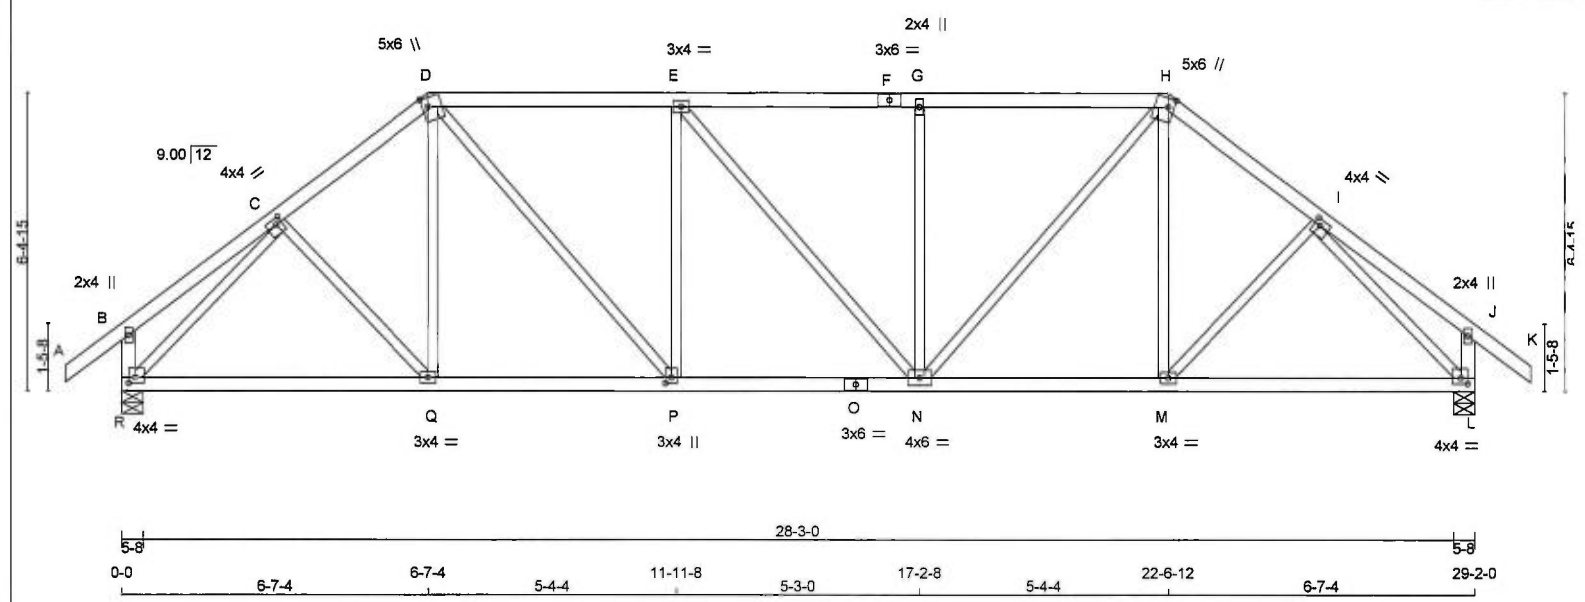

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR.					TOTAL WEIGHT = 2 X 129 = 258 lb									
A - D	2x4	DRY	No.2	SPF										
D - F	2x4	DRY	No.2	SPF										
F - H	2x4	DRY	No.2	SPF										
H - K	2x4	DRY	No.2	SPF										
R - B	2x4	DRY	No.2	SPF										
L - J	2x4	DRY	No.2	SPF										
R - O	2x4	DRY	No.2	SPF										
O - L	2x4	DRY	No.2	SPF										
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF										
DRY: SEASONED LUMBER.														
PLATES (table is in inches)														
JT	TYPE	PLATES	W	LEN	Y	X								
B	TMV+p	MT20	2.0	4.0										
C	TMWW-t	MT20	4.0	4.0	1.50	1.50								
D	TTWW+m	MT20	5.0	6.0	2.25	1.50								
E	TMWW-t	MT20	3.0	4.0										
F	TS-t	MT20	3.0	6.0										
G	TMV+w	MT20	2.0	4.0										
H	TTWW+m	MT20	5.0	6.0	2.25	1.50								
I	TMWW-t	MT20	4.0	4.0	1.50	1.50								
J	TMV+p	MT20	2.0	4.0										
L	BMVW1-t	MT20	4.0	4.0	1.50	1.75								
M	BMVW1-t	MT20	3.0	4.0										
N	BMVW1-t	MT20	4.0	6.0										
O	BS-t	MT20	3.0	6.0										
P	BMVW1-t	MT20	3.0	4.0	1.50	1.50								
Q	BMVW1-t	MT20	3.0	4.0										
R	BMVW1-t	MT20	4.0	4.0	1.50	1.75								

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER														
BEARINGS														
		FACTORED		MAXIMUM FACTORED		INPUT		REQRD						
		GROSS REACTION		GROSS REACTION		BRG		BRG						
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX						
R		1484	0	1484	0	0	5-8	5-8						
L		1484	0	1484	0	0	5-8	5-8						
UNFACTORED REACTIONS														
		1ST LCASE	MAX./MIN. COMPONENT REACTIONS											
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL							
R		1039	740 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0						
L		1039	740 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0						
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, L														
BRACING														
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.79 FT.														
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.														
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.														
LOADING														
TOTAL LOAD CASES: (4)														
CHORDS														
		MAX. FACTORED		FACTORED										
MEMB.	FORCE	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED							
	(LBS)	(PLF)	CSI (LC)	UNBRAC	LENGTH		FORCE	MAX						
FR-TO		FROM	TO			FR-TO	(LBS)	CSI (LC)						
A-B	0 / 30	-77.4	-77.4	0.09 (1)	10.00	C-Q	0 / 60	0.02 (4)						
B-C	0 / 16	-77.4	-77.4	0.12 (1)	10.00	Q-D	0 / 94	0.03 (4)						
C-D	-1481 / 0	-77.4	-77.4	0.15 (1)	5.24	D-P	0 / 703	0.16 (1)						
D-E	-1634 / 0	-77.4	-77.4	0.36 (1)	4.79	P-E	-443 / 0	0.29 (1)						
E-F	-1633 / 0	-77.4	-77.4	0.35 (1)	4.79	E-N	-2 / 0	0.00 (1)						
F-G	-1633 / 0	-77.4	-77.4	0.35 (1)	4.79	N-G	-443 / 0	0.29 (1)						
G-H	-1633 / 0	-77.4	-77.4	0.35 (1)	4.80	N-H	0 / 701	0.16 (1)						
H-I	-1481 / 0	-77.4	-77.4	0.15 (1)	5.24	M-H	0 / 94	0.03 (4)						
I-J	0 / 16	-77.4	-77.4	0.12 (1)	10.00	M-I	0 / 60	0.02 (4)						
J-K	0 / 30	-77.4	-77.4	0.09 (1)	10.00	R-C	-1672 / 0	0.63 (1)						
R-B	-201 / 0	0.0	0.0	0.02 (1)	7.81	I-L	-1672 / 0	0.63 (1)						
L-J	-201 / 0	0.0	0.0	0.02 (1)	7.81									
R-Q	0 / 1128	-17.5	-17.5	0.27 (1)	10.00									
Q-P	0 / 1170	-17.5	-17.5	0.28 (1)	10.00									
P-O	0 / 1634	-17.5	-17.5	0.31 (1)	10.00									
O-N	0 / 1634	-17.5	-17.5	0.31 (1)	10.00									
N-M	0 / 1171	-17.5	-17.5	0.28 (1)	10.00									
M-L	0 / 1128	-17.5	-17.5	0.28 (1)	10.00									

DESIGN CRITERIA														
SPECIFIED LOADS:														
TOP CH.	LL	=	23.3	PSF										
	DL	=	3.0	PSF										
BOT CH.	LL	=	0.0	PSF										
	DL	=	7.0	PSF										
TOTAL LOAD	=	33.3	PSF											
SPACING = 24.0 IN./C														
LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM														
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010														
THIS DESIGN COMPLIES WITH:														
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014														
- CSA 086-09														
- TPIC 2011														
(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD														
ALLOWABLE DEFL.(LL)= L/360 (0.97")														
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.07")														
ALLOWABLE DEFL.(TL)= L/360 (0.97")														
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.13")														
CSI: TC=0.36/1.00 (D-E:1) , BC=0.31/1.00 (N-P:1) ,														
WB=0.63/1.00 (I-L:1) , SSI=0.19/1.00 (D-E:1)														
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10														
COMP=1.10 SHEAR=1.10 TENS= 1.10														
COMPANION LIVE LOAD FACTOR = 0.50														
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .														
NAIL VALUES														
PLATE GRIP(DRY)	SHEAR	SECTION												
(PSI)	(PLI)	(PLI)												
MAX MIN	MAX MIN	MAX MIN												
MT20	618	354	1667	822	2284	1656								
PLATE PLACEMENT TOL. = 0.250 inches														
PLATE ROTATION TOL. = 5.0 Deg.														
JSI GRIP= 0.89 (I) (INPUT = 0.90)														
JSI METAL= 0.62 (I) (INPUT = 1.00)														

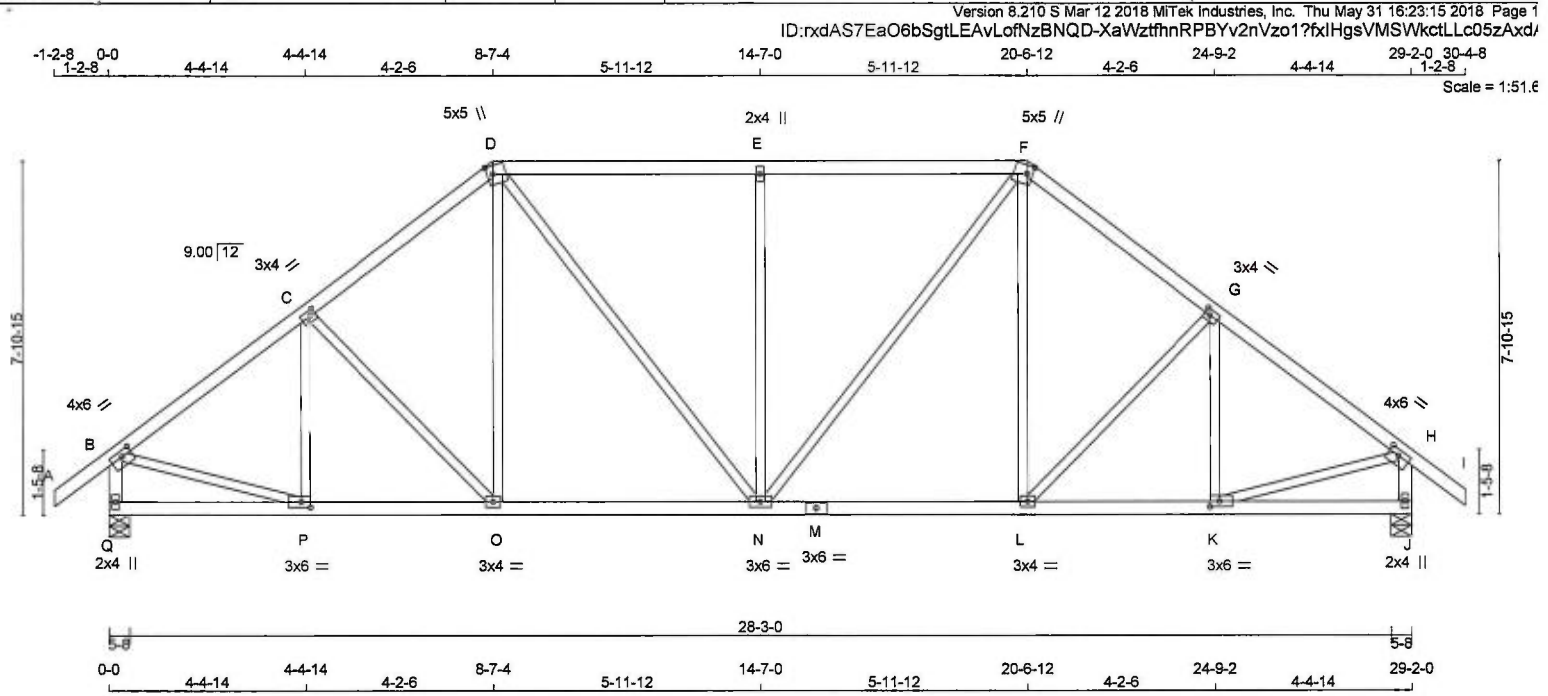

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE		Lumber	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
Q - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
Q - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	4.0	6.0	1.50 2.75
C	TMVW-t	MT20	3.0	4.0	1.50 1.50
D	TTWW+m	MT20	5.0	5.0	2.25 1.50
E	TMW+t	MT20	2.0	4.0	
F	TTWW+m	MT20	5.0	5.0	2.25 1.50
G	TMVW-t	MT20	3.0	4.0	1.50 1.50
H	TMVW-t	MT20	4.0	6.0	1.50 2.75
J	BMV1+p	MT20	2.0	4.0	
K	BMVW-t	MT20	3.0	6.0	1.50 2.50
L	BMVW-t	MT20	3.0	4.0	
M	BS-t	MT20	3.0	6.0	
N	BMVWWW-t	MT20	3.0	6.0	
O	BMVW-t	MT20	3.0	4.0	
P	BMVW-t	MT20	3.0	6.0	1.50 2.50
Q	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	RECORD

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQ'D BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
Q	1484	0	1484	0	0	5-8	5-8
J	1484	0	1484	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
Q	1039	740 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0
J	1039	740 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.10 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MAX. FACTORED		FACTORED		MAX. UNBRAC	MAX. FACTORED				
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)		MEMB.	FORCE (LBS)	MAX CSI (LC)		
FR-TO		FROM	TO	LENGTH	FR-TO				
A-B	0 / 30	-77.4	-77.4	0.09 (1)	10.00	P-C	-235 / 0	0.08 (1)	
B-C	-1488 / 0	-77.4	-77.4	0.21 (1)	5.18	C-O	-146 / 0	0.10 (1)	
C-D	-1411 / 0	-77.4	-77.4	0.20 (1)	5.29	O-D	0 / 197	0.04 (1)	
D-E	-1374 / 0	-77.4	-77.4	0.38 (1)	5.10	D-N	0 / 427	0.10 (1)	
E-F	-1374 / 0	-77.4	-77.4	0.38 (1)	5.10	N-E	-566 / 0	0.67 (1)	
F-G	-1411 / 0	-77.4	-77.4	0.20 (1)	5.29	N-F	0 / 427	0.10 (1)	
G-H	-1488 / 0	-77.4	-77.4	0.21 (1)	5.18	L-F	0 / 197	0.04 (1)	
H-I	0 / 30	-77.4	-77.4	0.09 (1)	10.00	L-G	-146 / 0	0.10 (1)	
Q-B	-1449 / 0	0.0	0.0	0.15 (1)	6.79	K-G	-235 / 0	0.08 (1)	
J-H	-1449 / 0	0.0	0.0	0.15 (1)	6.79	B-P	0 / 1248	0.28 (1)	
						K-H	0 / 1248	0.28 (1)	
Q-P	0 / 0	-17.5	-17.5	0.07 (4)	10.00				
P-O	0 / 1209	-17.5	-17.5	0.25 (1)	10.00				
O-N	0 / 1110	-17.5	-17.5	0.24 (1)	10.00				
N-M	0 / 1110	-17.5	-17.5	0.24 (1)	10.00				
M-L	0 / 1110	-17.5	-17.5	0.24 (1)	10.00				
L-K	0 / 1209	-17.5	-17.5	0.25 (1)	10.00				
K-J	0 / 0	-17.5	-17.5	0.07 (4)	10.00				

DESIGN CRITERIA

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.0	PSF
TOTAL LOAD	=	33.3	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A
SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.10")

CSI: TC=0.38/1.00 (D-E:1), BC=0.25/1.00 (O-P:1),
WB=0.67/1.00 (E-N:1), SSI=0.22/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES						
PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (N) (INPUT = 0.90)
JSI METAL= 0.41 (B) (INPUT = 1.00)



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



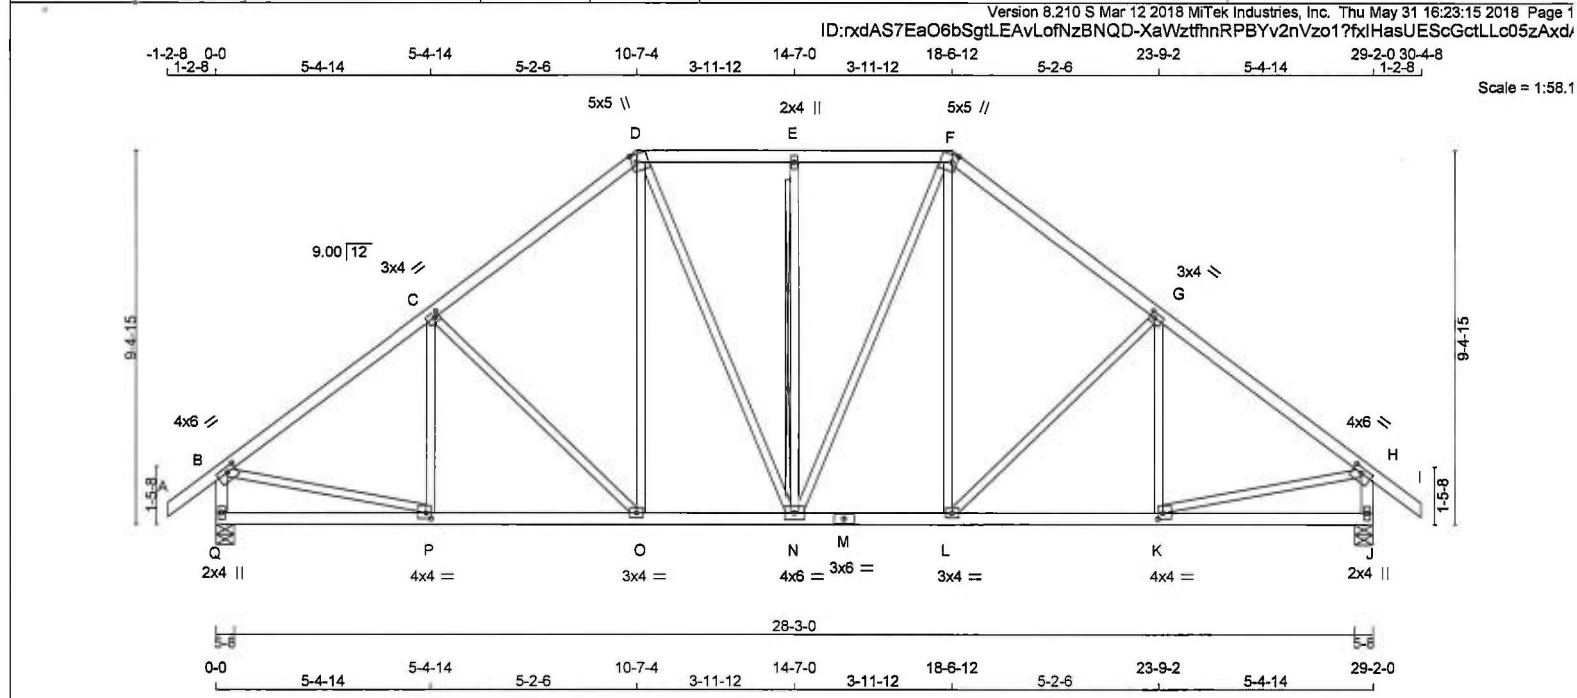


LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. A - D 2x4 DRY No.2 SPF B - F 2x4 DRY No.2 SPF C - I 2x4 DRY No.2 SPF Q - B 2x4 DRY No.2 SPF J - H 2x4 DRY No.2 SPF Q - M 2x4 DRY No.2 SPF M - J 2x4 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT DRY: SEASONED LUMBER.			DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED MAXIMUM FACTORED INPUT REQD GROSS REACTION GROSS REACTION BRG BRG JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX Q 1484 0 1484 0 0 5-8 5-8 J 1484 0 1484 0 0 5-8 5-8 UNFACTORED REACTIONS 1ST LOASE MAX./MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL Q 1039 740 / 0 0 / 0 0 / 0 299 / 0 0 / 0 J 1039 740 / 0 0 / 0 0 / 0 299 / 0 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, J BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.01 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. 2x4 DRY SPF No.2 T-BRACE AT E-N FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH. END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW LOADING TOTAL LOAD CASES: (4)			DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 23.3 PSF DL = 3.0 PSF BOT CH. LL = 0.0 PSF DL = 7.0 PSF TOTAL LOAD = 33.3 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010 THIS DESIGN COMPLIES WITH: - PART 9 OF OBC 2012, CBC 2012, ABC 2014 - CSA 086-09 - TPIC 2011 (55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL)= L/360 (0.97") CALCULATED VERT. DEFL.(LL) = L/ 999 (0.05") ALLOWABLE DEFL.(TL)= L/360 (0.97") CALCULATED VERT. DEFL.(TL) = L/ 999 (0.09") CSI: TC=0.32/1.00 (G-H:1) , BC=0.28/1.00 (K-L:1) , WB=0.31/1.00 (G-L:1) , SSI=0.16/1.00 (G-H:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10 COMPANION LIVE LOAD FACTOR = 0.50 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT . NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 822 2284 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.88 (P) (INPUT = 0.90) JSI METAL= 0.46 (P) (INPUT = 1.00)		
PLATES (table is in inches) JT TYPE PLATES W LEN Y X B TMVW-t MT20 4.0 6.0 1.50 2.75 C TMVW-t MT20 3.0 4.0 1.50 1.50 D TTWW+m MT20 5.0 5.0 2.25 1.50 E TMVW+w MT20 2.0 4.0 F TTWW+m MT20 5.0 5.0 2.25 1.50 G TMVW-t MT20 3.0 4.0 1.50 1.50 H TMVW-t MT20 4.0 6.0 1.50 2.75 J BMV1+p MT20 2.0 4.0 K BMVW-t MT20 4.0 4.0 1.75 1.50 L BMVW-t MT20 3.0 4.0 M BS-t MT20 3.0 6.0 N BMVW-t MT20 4.0 6.0 O BMVW-t MT20 3.0 4.0 P BMVW-t MT20 4.0 4.0 1.75 1.50 Q BMV1+p MT20 2.0 4.0			CHORDS MAX. FACTORED FORCE VERT. LOAD LC1 MAX (PLF) CSI (LC) MEMB. FROM TO FR-TO A-B 0 / 30 -77.4 -77.4 0.09 (1) B-C -1513 / 0 -77.4 -77.4 0.32 (1) C-D -1315 / 0 -77.4 -77.4 0.31 (1) D-E -1123 / 0 -77.4 -77.4 0.16 (1) E-F -1123 / 0 -77.4 -77.4 0.16 (1) F-G -1315 / 0 -77.4 -77.4 0.31 (1) G-H -1513 / 0 -77.4 -77.4 0.32 (1) H-I 0 / 30 -77.4 -77.4 0.09 (1) Q-B -1444 / 0 0.0 0.0 0.15 (1) J-H -1444 / 0 0.0 0.0 0.15 (1) Q-P 0 / 0 -17.5 -17.5 0.12 (4) P-O 0 / 1234 -17.5 -17.5 0.26 (1) O-N 0 / 1030 -17.5 -17.5 0.21 (1) N-M 0 / 1030 -17.5 -17.5 0.21 (1) M-L 0 / 1030 -17.5 -17.5 0.21 (1) L-K 0 / 1234 -17.5 -17.5 0.26 (1) K-J 0 / 0 -17.5 -17.5 0.12 (4)			WEBS MAX. FACTORED FORCE MAX (LC) MEMB. FROM TO FR-TO P-C -154 / 45 0.07 (1) C-O -290 / 0 0.31 (1) O-D 0 / 284 0.06 (1) D-N 0 / 234 0.05 (1) N-E -368 / 0 0.24 (1) E-F 0 / 234 0.05 (1) F-G 0 / 284 0.06 (1) G-H -290 / 0 0.31 (1) H-I -154 / 45 0.07 (1) I-J 0 / 1260 0.28 (1) J-K 0 / 1260 0.28 (1) K-H 0 / 1260 0.28 (1)		



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.




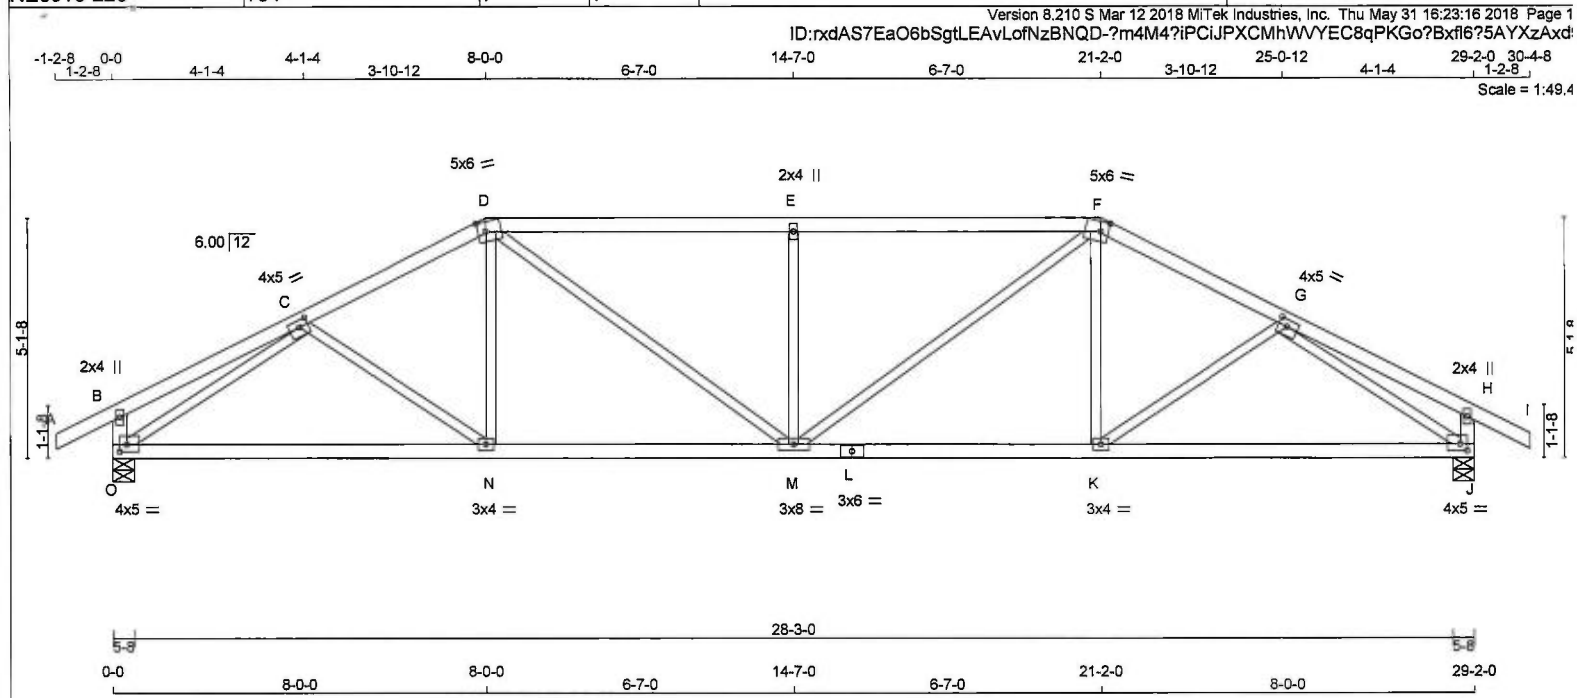

TOTAL WEIGHT = 112 lb										[M]F									
LUMBER					DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										DESIGN CRITERIA				
N. L. G. A. RULES																			
CHORDS SIZE																			
LUMBER					DESCR.														
A - D 2x4 DRY No.2 SPF					BEARINGS										SPECIFIED LOADS:				
D - F 2x4 DRY No.2 SPF					FACTORED MAXIMUM FACTORED INPUT REQRD										TOP CH. LL = 23.3 PSF				
F - I 2x4 DRY No.2 SPF					GROSS REACTION GROSS REACTION BRG BRG										DL = 3.0 PSF				
O - B 2x4 DRY No.2 SPF					JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX										BOT CH. LL = 0.0 PSF				
J - H 2x4 DRY No.2 SPF					O 1482 0 1482 0 0 5-8 5-8										DL = 7.0 PSF				
O - L 2x4 DRY No.2 SPF					J 1482 0 1482 0 0 5-8 5-8										TOTAL LOAD = 33.3 PSF				
L - J 2x4 DRY No.2 SPF																			
ALL WEBS 2x3 DRY No.2 SPF					UNFACTORED REACTIONS										SPACING = 24.0 IN. C/C				
EXCEPT					1ST LCASE MAX./MIN. COMPONENT REACTIONS										LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM				
DRY: SEASONED LUMBER.					JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL										THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010				
					O 1038 739 / 0 0 / 0 0 / 0 0 / 0 299 / 0 0 / 0										THIS DESIGN COMPLIES WITH:				
					J 1038 739 / 0 0 / 0 0 / 0 0 / 0 299 / 0 0 / 0										- PART 9 OF OBC 2012 , CBC 2012 , ABC 2014				
					BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, J										- CSA 086-09				
					BRACING										- TPIC 2011				
					TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.09 FT.										(55% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD				
					MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.										ALLOWABLE DEFL.(LL)= L/360 (0.97")				
					ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.										CALCULATED VERT. DEFL.(LL) = L/ 999 (0.11")				
					LOADING										ALLOWABLE DEFL.(TL)= L/360 (0.97")				
					TOTAL LOAD CASES: (4)										CALCULATED VERT. DEFL.(TL) = L/ 999 (0.19")				
					CHORDS WEBS										CSI: TC=0.52/1.00 (D-E:1) , BC=0.41/1.00 (N-O:1) , WB=0.82/1.00 (C-O:1) , SSI=0.25/1.00 (D-E:1)				
					MEMB. MAX. FACTORED FORCE VERT. LOAD LC1 MAX. MAX. MEMB. MAX. FACTORED FORCE MAX.										DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10				
					(LBS) (PLF) CSI (LC) UNBRAC LENGTH FR-TO (LBS) CSI (LC)										COMP=1.10 SHEAR=1.10 TENS= 1.10				
					FR-TO FROM TO										COMPANION LIVE LOAD FACTOR = 0.50				
					A-B 0 / 22 -77.4 -77.4 0.09 (1) 10.00 C-N -29 / 57 0.02 (4)										TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .				
					B-C 0 / 14 -77.4 -77.4 0.17 (1) 10.00 N-D 0 / 169 0.05 (4)										NAIL VALUES				
					C-D -1898 / 0 -77.4 -77.4 0.18 (1) 4.74 D-M 0 / 605 0.14 (1)										PLATE GRIP(DRY) SHEAR SECTION				
					D-E -2175 / 0 -77.4 -77.4 0.52 (1) 4.09 M-E -626 / 0 0.24 (1)														
					E-F -2175 / 0 -77.4 -77.4 0.52 (1) 4.09 M-F 0 / 605 0.14 (1)														
					F-G -1898 / 0 -77.4 -77.4 0.18 (1) 4.74 K-F 0 / 169 0.05 (4)														
					G-H 0 / 14 -77.4 -77.4 0.17 (1) 10.00 K-G -29 / 57 0.02 (4)														
					H-I 0 / 22 -77.4 -77.4 0.09 (1) 10.00 O-C -2088 / 0 0.82 (1)														
					O-B -223 / 0 0.0 0.0 0.02 (1) 7.81 G-J -2088 / 0 0.82 (1)														
					J-H -223 / 0 0.0 0.0 0.02 (1) 7.81														
					O-N 0 / 1708 -17.5 -17.5 0.41 (1) 10.00														
					N-M 0 / 1688 -17.5 -17.5 0.41 (1) 10.00														
					M-L 0 / 1688 -17.5 -17.5 0.41 (1) 10.00														
					L-K 0 / 1688 -17.5 -17.5 0.41 (1) 10.00														
					K-J 0 / 1708 -17.5 -17.5 0.41 (1) 10.00														

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



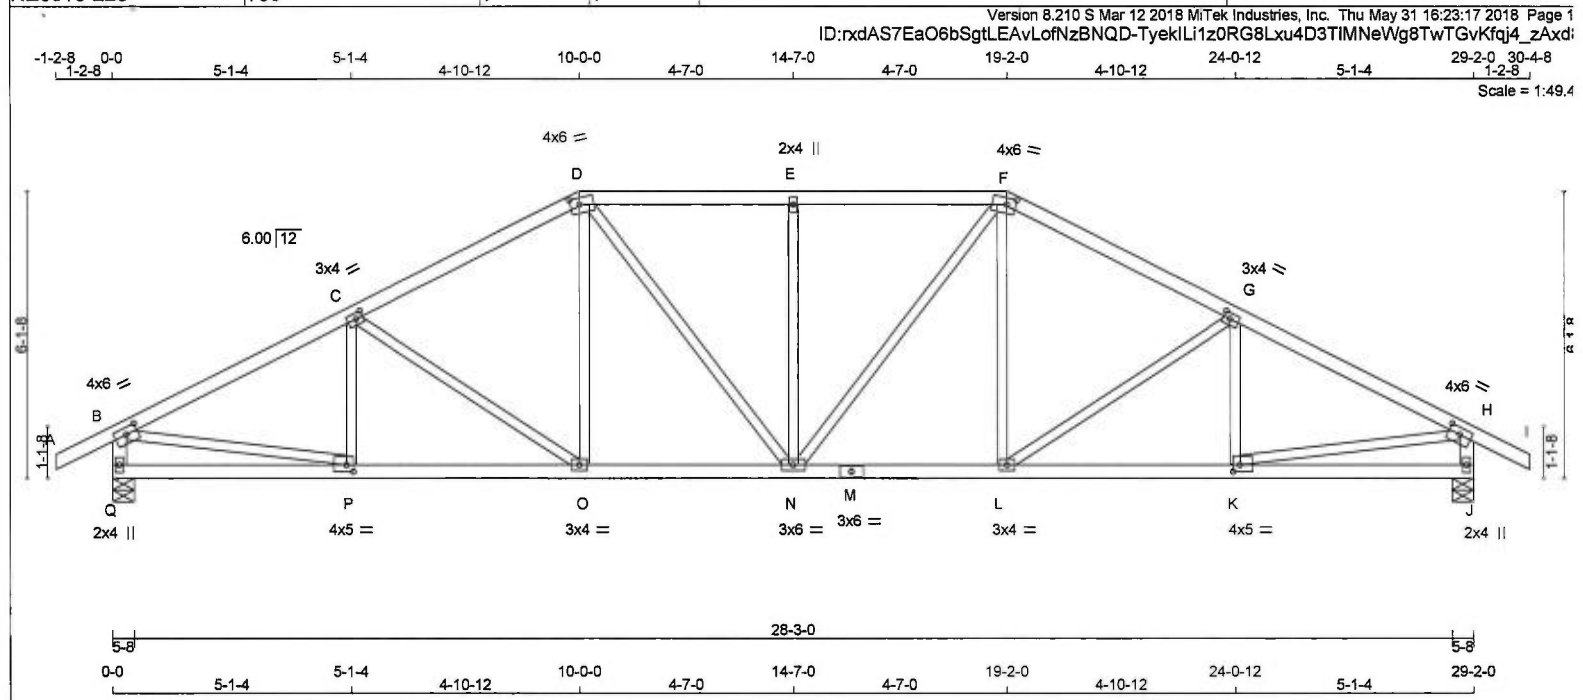


										TOTAL WEIGHT = 121 lb		
LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							DESIGN CRITERIA	
				BEARINGS								
				FACTORED		MAXIMUM FACTORED		INPUT		REQRD		
				GROSS REACTION		GROSS REACTION		BRG		BRG		
				JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
A - D	2x4	DRY	No.2	SPF								
D - F	2x4	DRY	No.2	SPF								
F - I	2x4	DRY	No.2	SPF								
Q - B	2x4	DRY	No.2	SPF								
J - H	2x4	DRY	No.2	SPF								
Q - M	2x4	DRY	No.2	SPF								
M - J	2x4	DRY	No.2	SPF								
				UNFACTORED REACTIONS								
				1ST LCASE		MAX./MIN. COMPONENT REACTIONS						
				JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
ALL WEBS	2x3	DRY	No.2	SPF								
EXCEPT												
DRY: SEASONED LUMBER.											SPECIFIED LOADS: TOP CH. LL = 23.3 PSF DL = 3.0 PSF BOT CH. LL = 0.0 PSF DL = 7.0 PSF TOTAL LOAD = 33.3 PSF	
											SPACING = 24.0 IN. C/C	
											LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM	

PLATES (table is in inches)						BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, J						THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010					
JT	TYPE	PLATES	W	LEN	Y	X	BRACING						THIS DESIGN COMPLIES WITH:				
B	TMVW-t	MT20	4.0	6.0	1.75	3.00	TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.52 FT.						- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014				
C	TMWW-t	MT20	3.0	4.0	1.50	1.75	MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.						- CSA 086-09				
D	TTWW-m	MT20	4.0	6.0	1.75	2.25	ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.						- TPIC 2011				
E	TMW+w	MT20	2.0	4.0			LOADING						(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD				
F	TTWW-m	MT20	4.0	6.0	1.75	2.25	TOTAL LOAD CASES: (4)						ALLOWABLE DEFL.(LL)= L/360 (0.97")				
G	TMWW-t	MT20	3.0	4.0	1.50	1.75	CHORDS						CALCULATED VERT. DEFL.(LL)= L/ 999 (0.09")				
H	TMVW-t	MT20	4.0	6.0	1.75	3.00	MAX. FACTORED						ALLOWABLE DEFL.(TL)= L/360 (0.97")				
J	BMV1+p	MT20	2.0	4.0			MAX. FACTORED						CALCULATED VERT. DEFL.(TL)= L/ 999 (0.16")				
K	BMWW-t	MT20	4.0	5.0	1.75	1.75	MEMB. FORCE (LBS)						CSI: TC=0.30/1.00 (B-C:1) , BC=0.34/1.00 (O-P:1) ,				
L	BMWW-t	MT20	3.0	4.0			VERT. LOAD LC1 MAX. UNBRACED LENGTH						WB=0.41/1.00 (B-P:1) , SSI=0.17/1.00 (D-E:1)				
M	BS-t	MT20	3.0	6.0			FR-TO						DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10				
N	BMWW-t	MT20	3.0	6.0			FROM TO						COMP=1.10 SHEAR=1.10 TENS= 1.10				
O	BMWW-t	MT20	3.0	4.0			FR-TO						COMPANION LIVE LOAD FACTOR = 0.50				
P	BMWW-t	MT20	4.0	5.0	1.75	1.75	FR-TO						TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.				
Q	BMV1+p	MT20	2.0	4.0			FR-TO						NAIL VALUES				
							FR-TO						PLATE GRIP(DRY) SHEAR SECTION				
							FR-TO						(PSI) (PLI) (PLI)				
							FR-TO						MAX MIN MAX MIN MAX MIN				



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



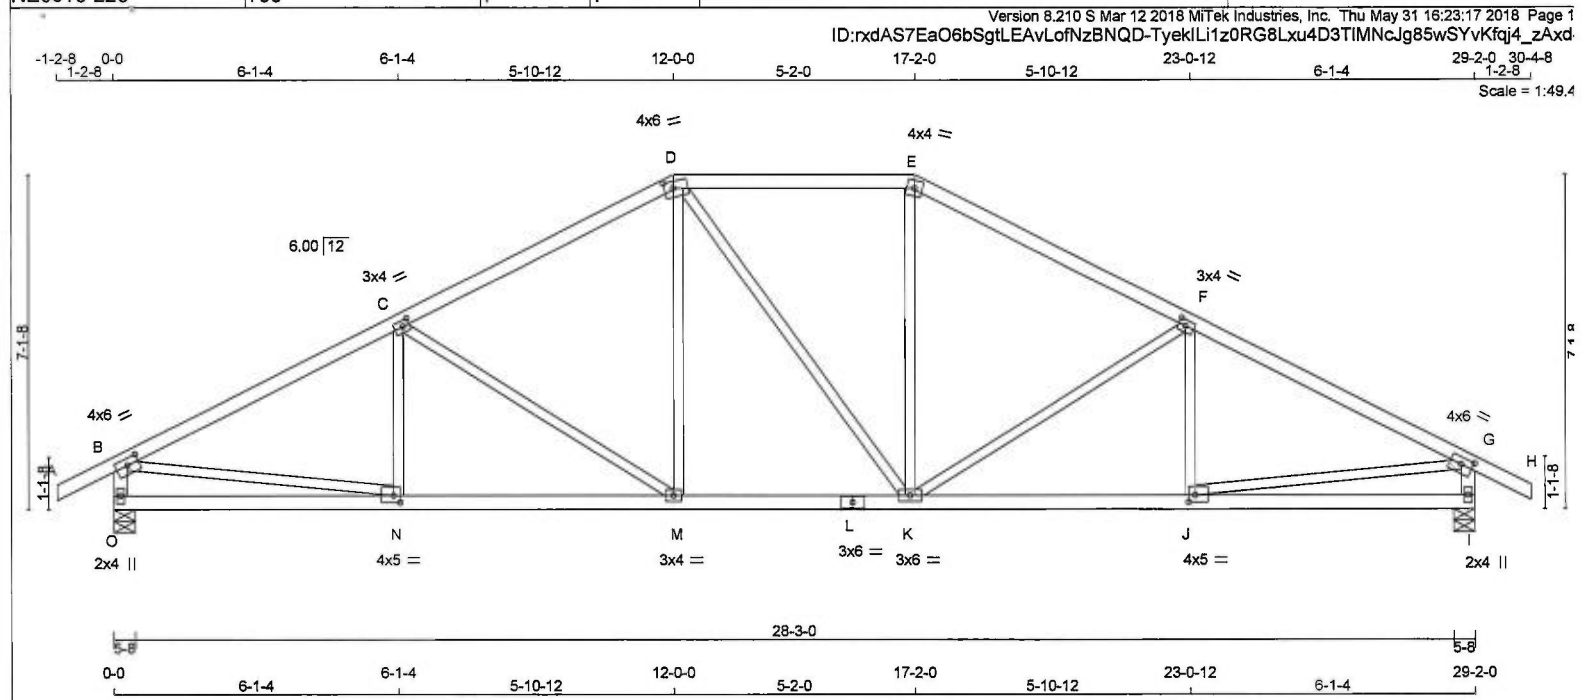

										TOTAL WEIGHT = 118 lb						
LUMBER					DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										DESIGN CRITERIA	
N. L. G. A. RULES															[M][F]	
CHORDS		SIZE	LUMBER	DESCR.	BEARINGS										SPECIFIED LOADS:	
A - D	2x4	DRY	No.2	SPF	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG		TOP CH. LL = 23.3 PSF				
D - E	2x4	DRY	No.2	SPF	JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	DL = 3.0 PSF			
E - H	2x4	DRY	No.2	SPF	O	1482	0	1482	0	0	5-8	5-8	BOT CH. LL = 0.0 PSF			
O - B	2x4	DRY	No.2	SPF	I	1482	0	1482	0	0	5-8	5-8	DL = 7.0 PSF			
I - G	2x4	DRY	No.2	SPF										TOTAL LOAD = 33.3 PSF		
O - L	2x4	DRY	No.2	SPF												
L - I	2x4	DRY	No.2	SPF												
ALL WEBS EXCEPT					UNFACTORED REACTIONS										SPACING = 24.0 IN. C/C	
					1ST LCASE		MAX./MIN. COMPONENT REACTIONS									
					JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL				
					O	1038	739 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0				
					I	1038	739 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0				
DRY: SEASONED LUMBER.															LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM	

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	4.0	6.0	1.75 3.00
C	TMVW-t	MT20	3.0	4.0	1.50 1.75
D	TTVW-m	MT20	4.0	6.0	1.75 2.25
E	TTW-m	MT20	4.0	4.0	
F	TMVW-t	MT20	3.0	4.0	1.50 1.75
G	TMVW-t	MT20	4.0	6.0	1.75 3.00
I	BMV1-p	MT20	2.0	4.0	
J	BMVW-t	MT20	4.0	5.0	1.75 1.75
K	BMVW-t	MT20	3.0	6.0	
L	BS-t	MT20	3.0	6.0	
M	BMVW-t	MT20	3.0	4.0	
N	BMVW-t	MT20	4.0	5.0	1.75 1.75
O	BMV1-p	MT20	2.0	4.0	


BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, I									
BRACING									
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.34 FT.									
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.									
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.									
LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FROM	TO	LENGTH	FR-TO				
A-B	0 / 22	-77.4	-77.4	0.09 (1)	10.00	N-C	-128 / 64	0.03 (1)	
B-C	-2015 / 0	-77.4	-77.4	0.44 (1)	4.34	C-M	-465 / 0	0.46 (1)	
C-D	-1628 / 0	-77.4	-77.4	0.40 (1)	4.77	M-D	0 / 346	0.08 (1)	
D-E	-1439 / 0	-77.4	-77.4	0.29 (1)	5.13	D-K	0 / 0	0.00 (1)	
E-F	-1628 / 0	-77.4	-77.4	0.40 (1)	4.77	K-E	0 / 347	0.08 (1)	
F-G	-2015 / 0	-77.4	-77.4	0.44 (1)	4.34	K-F	-464 / 0	0.46 (1)	
G-H	0 / 22	-77.4	-77.4	0.09 (1)	10.00	J-F	-129 / 63	0.03 (1)	
O-B	-1437 / 0	0.0	0.0	0.14 (1)	6.81	B-N	0 / 1840	0.41 (1)	
I-G	-1436 / 0	0.0	0.0	0.14 (1)	6.81	J-G	0 / 1840	0.41 (1)	
O-N	0 / 0	-17.5	-17.5	0.15 (4)	10.00				
N-M	0 / 1824	-17.5	-17.5	0.36 (1)	10.00				
M-L	0 / 1438	-17.5	-17.5	0.29 (1)	10.00				
L-K	0 / 1438	-17.5	-17.5	0.29 (1)	10.00				
K-J	0 / 1823	-17.5	-17.5	0.36 (1)	10.00				
J-I	0 / 0	-17.5	-17.5	0.15 (4)	10.00				

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010	
THIS DESIGN COMPLIES WITH:	
- PART 9 OF OBC 2012 , CBC 2012 , ABC 2014	
- CSA 086-09	
- TPIC 2011	
(55 % OF 27.2 P.S.F. G.S.L PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD	
ALLOWABLE DEFL.(LL)= L/360 (0.97")	
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.09")	
ALLOWABLE DEFL.(TL)= L/360 (0.97")	
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.16")	
CSI: TC=0.44/1.00 (B-C:1) , BC=0.36/1.00 (M-N:1) ,	
WB=0.46/1.00 (C-M:1) , SS=0.20/1.00 (F-G:1)	
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10	
COMP=1.10 SHEAR=1.10 TENS= 1.10	
COMPANION LIVE LOAD FACTOR = 0.50	
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .	
NAIL VALUES	
PLATE GRIP(DRY) SHEAR SECTION	



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



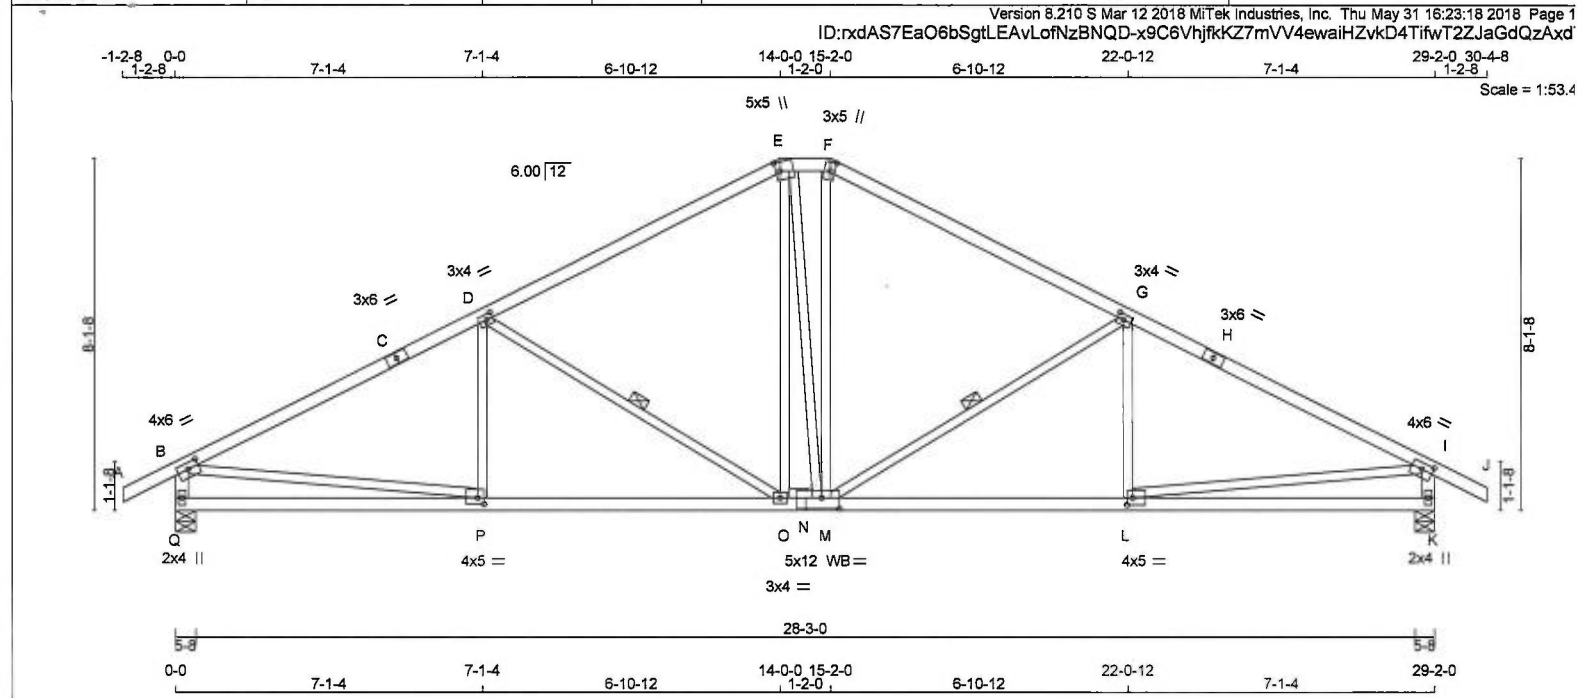

LUMBER						DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										TOTAL WEIGHT = 125 lb				
N. L. G. A. RULES																[M][F]				
CHORDS SIZE																				
A - C	2x4	DRY	No.2	SPF																
C - E	2x4	DRY	No.2	SPF																
E - F	2x4	DRY	No.2	SPF																
F - H	2x4	DRY	No.2	SPF																
H - J	2x4	DRY	No.2	SPF																
Q - B	2x4	DRY	No.2	SPF																
K - I	2x4	DRY	No.2	SPF																
Q - N	2x4	DRY	No.2	SPF																
N - K	2x4	DRY	No.2	SPF																
ALL WEBS 2x3 DRY No.2																				
EXCEPT																				
DRY: SEASONED LUMBER.																				
PLATES (table is in inches)																DESIGN CRITERIA				
JT	TYPE	PLATES	W	LEN	Y	X											SPECIFIED LOADS:			
B	TMVW-t	MT20	4.0	6.0	1.75	3.00											TOP CH. LL = 23.3 PSF			
C	TS-t	MT20	3.0	6.0													DL = 3.0 PSF			
D	TMVW-t	MT20	3.0	4.0	1.50	1.75											BOT CH. LL = 0.0 PSF			
E	TTWW+m	MT20	5.0	5.0	2.50	1.25											DL = 7.0 PSF			
F	TTWW+m	MT20	3.0	5.0	2.50	1.25											TOTAL LOAD = 33.3 PSF			
G	TMVW-t	MT20	3.0	4.0	1.50	1.75											SPACING = 24.0 IN. C/C			
H	TS-t	MT20	3.0	6.0													LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM			
I	TMVW-t	MT20	4.0	6.0	1.75	3.00											THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010			
K	BMV1+p	MT20	2.0	4.0													THIS DESIGN COMPLIES WITH:			
L	BMVW-t	MT20	4.0	5.0	2.00	1.50											- PART 9 OF OBC 2012, BCBC 2012, ABC 2014			
M																	- CSA 086-09			
N	BSWWW-t	MT20	5.0	12.0	3.00	5.00											- TPIC 2011			
O	BMVW-t	MT20	3.0	4.0													(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD			
P	BMVW-t	MT20	4.0	5.0	1.75	1.75											ALLOWABLE DEFL.(LL)= L/360 (0.97")			
Q	BMV1+p	MT20	2.0	4.0													CALCULATED VERT. DEFL.(LL) = L/ 999 (0.09")			
WB - INDICATES BLOCKING REQUIRED																ALLOWABLE DEFL.(TL)= L/360 (0.97")				
																CALCULATED VERT. DEFL.(TL) = L/ 999 (0.19")				
																CSI: TC=0.62/1.00 (B-D:1), BC=0.40/1.00 (O-P:1), WB=0.41/1.00 (B-P:1), SSI=0.24/1.00 (B-D:1)				
																DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10				
																COMPANION LIVE LOAD FACTOR = 0.50				
																TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .				
																NAIL VALUES				
																PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)				
																MAX MIN MAX MIN MAX MIN				
																MT20 618 354 1667 822 2284 1656				
																PLATE PLACEMENT TOL. = 0.250 inches				
																PLATE ROTATION TOL. = 5.0 Deg.				
																JSI GRIP= 0.90 (L) (INPUT = 0.90)				
																JSI METAL= 0.55 (P) (INPUT = 1.00)				

LICENSED PROFESSIONAL ENGINEER

N.A. EL-MASRI

PROVINCIAL OF ONTARIO


May 31, 2018

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



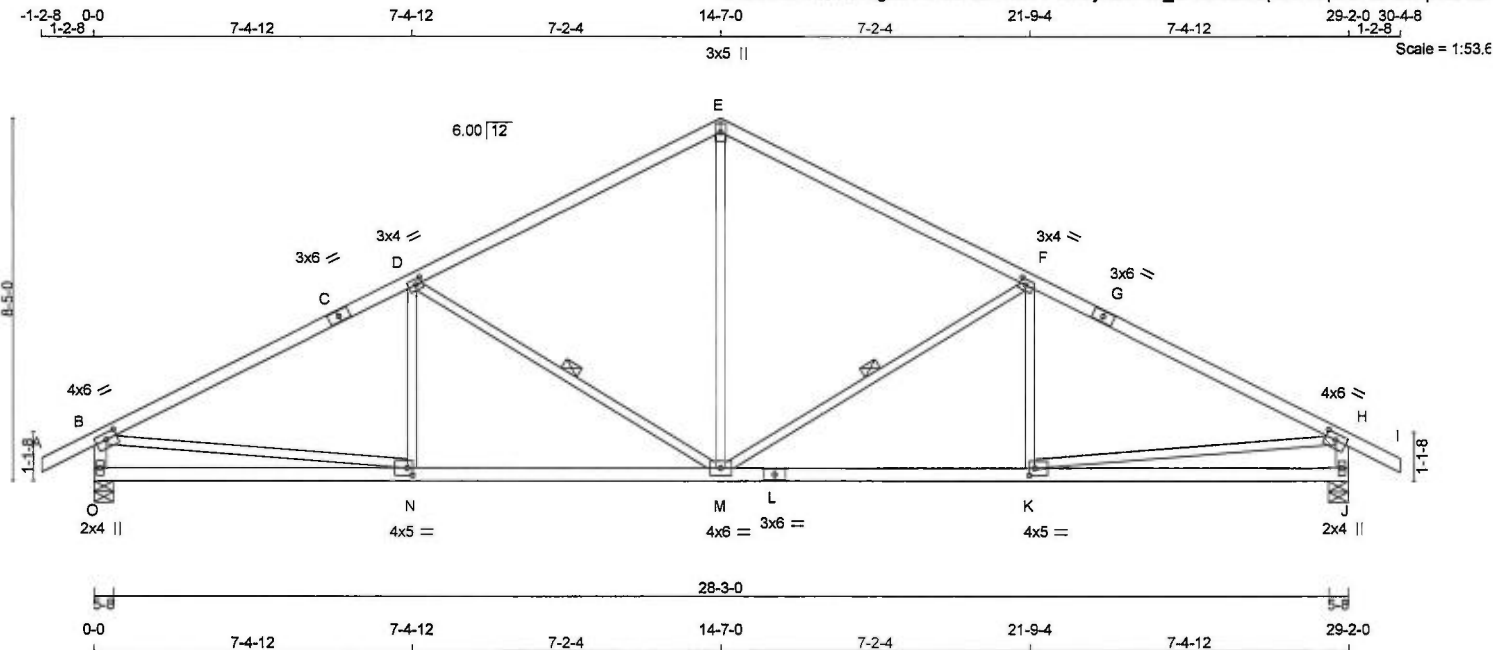

TOTAL WEIGHT = 10 X 113 = 1134 lb [M]F

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - E	2x4	DRY No.2	SPF
E - G	2x4	DRY No.2	SPF
G - I	2x4	DRY No.2	SPF
O - B	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
O - L	2x4	DRY No.2	SPF
L - J	2x4	DRY No.2	SPF

ALL WEBS EXCEPT DRY: SEASONED LUMBER.

PLATES (table is in inches)	W	LEN	Y	X
B TMVW-t MT20	4.0	6.0	1.75	3.00
C TS-t MT20	3.0	6.0		
D TMVW-t MT20	3.0	4.0	1.50	1.75
E TTW+p MT20	3.0	5.0		
F TMVW-t MT20	3.0	4.0	1.50	1.75
G TS-t MT20	3.0	6.0		
H TMVW-t MT20	4.0	6.0	1.75	3.00
J BMV1+p MT20	2.0	4.0		
K BMVW-t MT20	4.0	5.0	2.00	1.50
L BS-t MT20	3.0	6.0		
M BMVW-t MT20	4.0	6.0		
N BMVW-t MT20	4.0	5.0	2.00	1.50
O BMV1+p MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
O	1482	0	1482	0	0	5-8	5-8
J	1482	0	1482	0	0	5-8	5-8

UNFACTORED REACTIONS		MAX./MIN. COMPONENT REACTIONS		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
O	1038	739 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0
J	1038	739 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.03 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 - 1x4 LATERAL BRACE(S) AT 1/2 LENGTH OF F-M, D-M. DBS = 20-0-0. CBF = 84 LBS.

DBS = DIAGONAL BRACE SPACING (MAX). CBF = CUMULATIVE BRACING FORCE (PER BRACE). FASTEN LATERAL BRACE(S) USING (0.122"x3") SPIRAL NAILS: 1 NAIL FOR 2x3 BRACE(S), 2 FOR 1x4, 2x4, 2x5, 3 FOR 2x6, 4 FOR 2x8, 5 FOR 2x10, AND 6 FOR 2x12.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 22	-77.4 -77.4	0.09 (1)	10.00	M-E	0 / 835	0.19 (1)
B-C	-2004 / 0	-77.4 -77.4	0.68 (1)	4.03	M-F	-669 / 0	0.33 (1)
C-D	-2004 / 0	-77.4 -77.4	0.68 (1)	4.03	K-F	-61 / 103	0.04 (4)
D-E	-1431 / 0	-77.4 -77.4	0.59 (1)	4.70	D-M	-669 / 0	0.33 (1)
E-F	-1431 / 0	-77.4 -77.4	0.59 (1)	4.70	N-D	-61 / 103	0.04 (4)
F-G	-2004 / 0	-77.4 -77.4	0.68 (1)	4.03	B-N	0 / 1830	0.41 (1)
G-H	-2004 / 0	-77.4 -77.4	0.68 (1)	4.03	K-H	0 / 1830	0.41 (1)
H-I	0 / 22	-77.4 -77.4	0.09 (1)	10.00			
O-B	-1428 / 0	0.0 0.0	0.14 (1)	6.83			
J-H	-1428 / 0	0.0 0.0	0.14 (1)	6.83			
O-N	0 / 0	-17.5 -17.5	0.22 (4)	10.00			
N-M	0 / 1819	-17.5 -17.5	0.40 (1)	10.00			
M-L	0 / 1819	-17.5 -17.5	0.40 (1)	10.00			
L-K	0 / 1819	-17.5 -17.5	0.40 (1)	10.00			
K-J	0 / 0	-17.5 -17.5	0.22 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.18")

CSI: TC=0.68/1.00 (B-D:1), BC=0.40/1.00 (M-N:1), WB=0.41/1.00 (B-N:1), SSI=0.25/1.00 (B-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
	(PSI)	(PLI)	(PLI)		
MT20	618	354	1667	822	2284
	1656				

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (N) (INPUT = 0.90)
JSI METAL= 0.55 (K) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



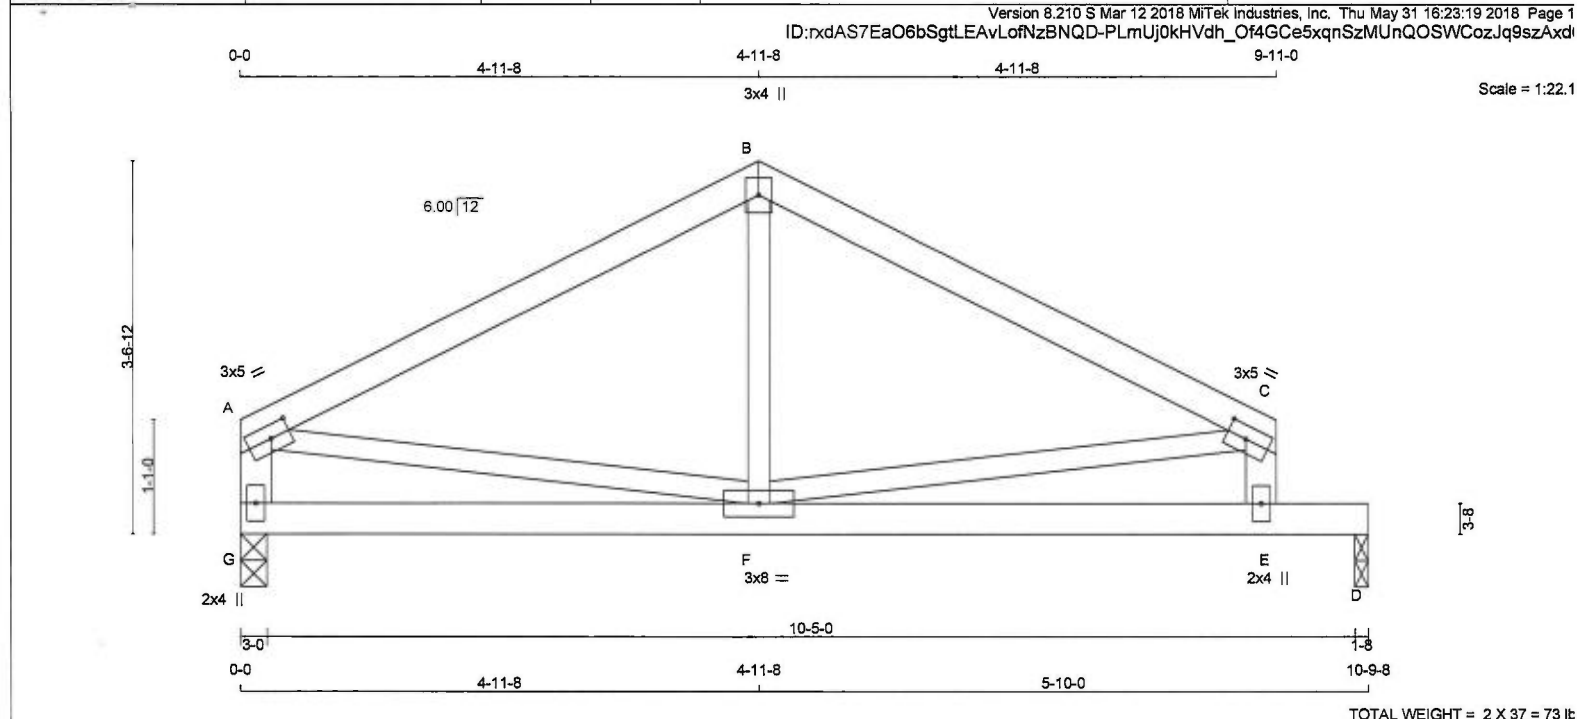

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS										DESIGN CRITERIA				
A - B	2x4	DRY	No.2	SPF	FACTORED		MAXIMUM FACTORED		INPUT		REQ'D		SPECIFIED LOADS:					
B - C	2x4	DRY	No.2	SPF	GROSS REACTION		GROSS REACTION		BRG		BRG		TOP CH. LL = 23.3 PSF					
G - A	2x4	DRY	No.2	SPF	JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	DL = 3.0 PSF					
E - C	2x4	DRY	No.2	SPF	G	512	0	512	0	0	3-0	3-0	BOT CH. LL = 0.0 PSF					
G - D	2x4	DRY	No.2	SPF	D	512	0	512	0	0	1-8	1-8	DL = 7.0 PSF					
ALL WEBS 2x3 DRY No.2 EXCEPT				SPF	UNFACTORED REACTIONS										TOTAL LOAD = 33.3 PSF			
DRY: SEASONED LUMBER.				UNFACTORED REACTIONS										SPACING = 24.0 IN. C/C				
				1ST LCASE MAX./MIN. COMPONENT REACTIONS										THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010				
				JT COMBINED SNOW LIVE PERM. LIVE WIND DEAD SOIL										THIS DESIGN COMPLIES WITH:				
				G 359 251 / 0 0 / 0 0 / 0 0 / 0 108 / 0 0 / 0										- PART 9 OF OBC 2012, BCBC 2012, ABC 2014				
				D 359 251 / 0 0 / 0 0 / 0 0 / 0 108 / 0 0 / 0										- CSA 086-09				
				BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G, D										- TPIC 2011				
				BRACING														
				TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.														
				MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.														
				ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.														
				LOADING														
				TOTAL LOAD CASES: (4)														
				CHORDS WEBS														
				MEMB. MAX. FACTORED FORCE (LBS) FACTORED VERT. LOAD (PLF) LC1 MAX (LC) UNBRAC LENGTH FR-TO														
				FR-TO														
				A-B -522 / 0 -77.4 -77.4 0.34 (1) 6.25 F-B 0 / 110 0.04 (4)														
				B-C -522 / 0 -77.4 -77.4 0.34 (1) 6.25 A-F 0 / 473 0.11 (1)														
				G-A -498 / 0 0.0 0.0 0.05 (1) 7.81 F-C 0 / 473 0.11 (1)														
				E-C -498 / 0 0.0 0.0 0.05 (1) 7.81														
				G-F 0 / 0 -17.5 -17.5 0.20 (1) 10.00														
				F-E 0 / 0 -17.5 -17.5 0.56 (1) 10.00														
				E-D 0 / 0 -94.9 -94.9 0.56 (1) 10.00														
														CSI: TC=0.34/1.00 (B-C:1), BC=0.56/1.00 (E-F:1), WB=0.11/1.00 (A-F:1), SSI=0.40/1.00 (D-E:1)				
														DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10				
														COMPANION LIVE LOAD FACTOR = 0.50				
														TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.				
														NAIL VALUES				
														PLATE GRIP(DRY) SHEAR SECTION				
														(PSI) (PLI) (PLI)				
														MAX MIN MAX MIN MAX MIN				
														MT20 618 354 1667 822 2284 1656				
														PLATE PLACEMENT TOL. = 0.250 inches				
														PLATE ROTATION TOL. = 5.0 Deg.				
														JSI GRIP= 0.52 (F) (INPUT = 0.90)				
														JSI METAL= 0.18 (A) (INPUT = 1.00)				

LICENSED PROFESSIONAL ENGINEER

N.A. EL-MASRI

N.A. El-Masri

PROVINCE OF ONTARIO

May 31, 2018


READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

KOTT



READ ALL NOTES ON THIS PAGE AND ON
 ENGINEERING NOTE PAGE ENP-1. THIS
 NOTE PAGE IS AN INTEGRAL PART OF
 THIS DRAWING AS IT CONTAINS
 SPECIFICATIONS AND CRITERIA USED IN
 THE DESIGN OF THIS COMPONENT.



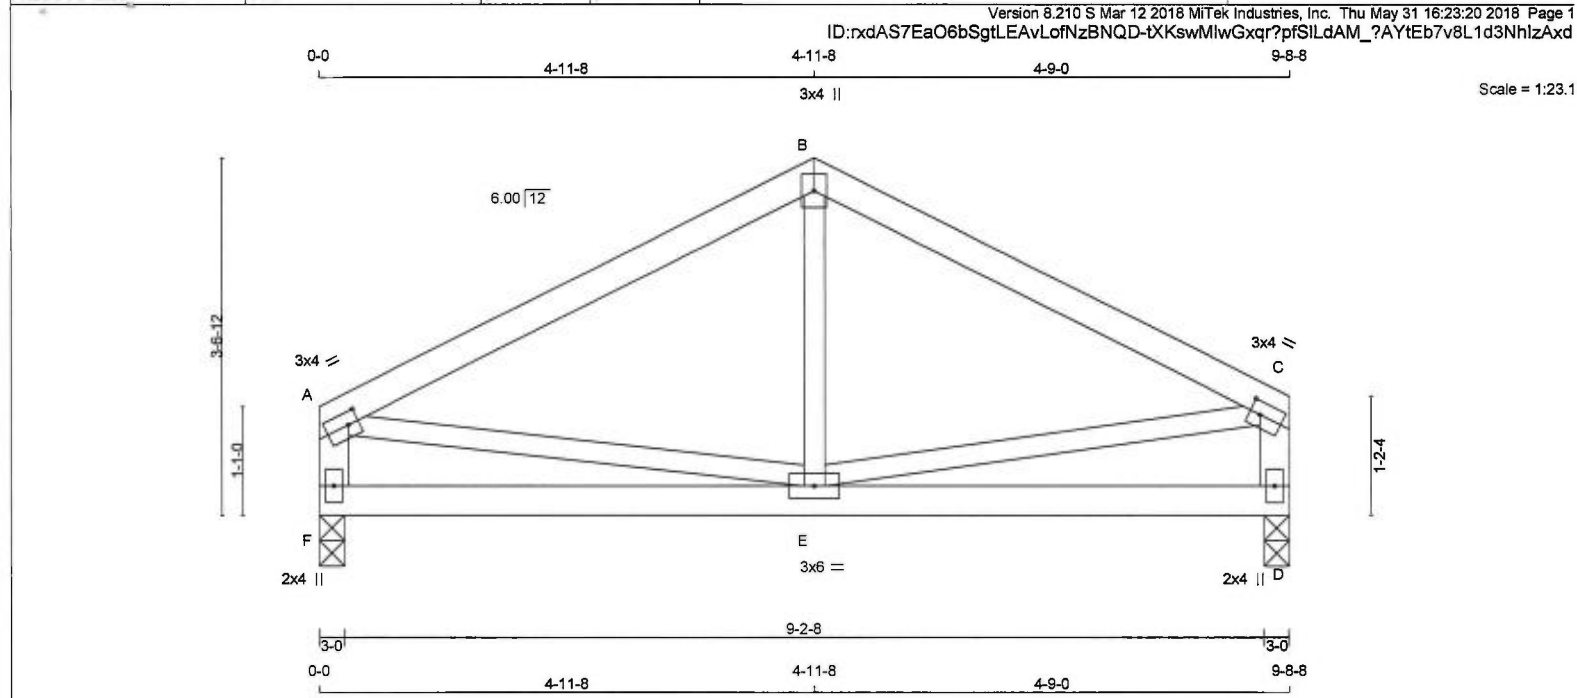

TOTAL WEIGHT = 35 lb
[M]F

LUMBER				DESCR.	
N. L. G. A. RULES	SIZE	LUMBER			
CHORDS					
A - B	2x4	DRY	No.2	SPF	
B - C	2x4	DRY	No.2	SPF	
F - A	2x4	DRY	No.2	SPF	
D - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	3.0	4.0	1.50	1.25
B	TTW+p	MT20	3.0	4.0		
C	TMVW-t	MT20	3.0	4.0	1.50	1.25
D	BMV1+p	MT20	2.0	4.0		
E	BMWWW-t	MT20	3.0	6.0		
F	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQRD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
F	460	0	460	0
D	460	0	460	0

UNFACTORED REACTIONS

1ST LCASE	MAX./MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	323	226 / 0	0 / 0	0 / 0	0 / 0	97 / 0	0 / 0
D	323	226 / 0	0 / 0	0 / 0	0 / 0	97 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM	TO				
A-B	-399 / 0	-77.4	-77.4 0.25 (1)	6.25	E-B	-18 / 78	0.03 (4)
B-C	-399 / 0	-77.4	-77.4 0.23 (1)	6.25	A-E	0 / 361	0.08 (1)
F-A	-426 / 0	0.0	0.0 0.04 (1)	7.81	E-C	0 / 363	0.08 (1)
D-C	-428 / 0	0.0	0.0 0.04 (1)	7.81			
F-E	0 / 0	-17.5	-17.5 0.12 (4)	10.00			
E-D	0 / 0	-17.5	-17.5 0.12 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.0	PSF
TOTAL LOAD		=	33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.32")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.32")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.25/1.00 (A-B:1), BC=0.12/1.00 (D-E:4), WB=0.08/1.00 (C-E:1), SSI=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.89 (C) (INPUT = 0.90)
JSI METAL= 0.18 (A) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



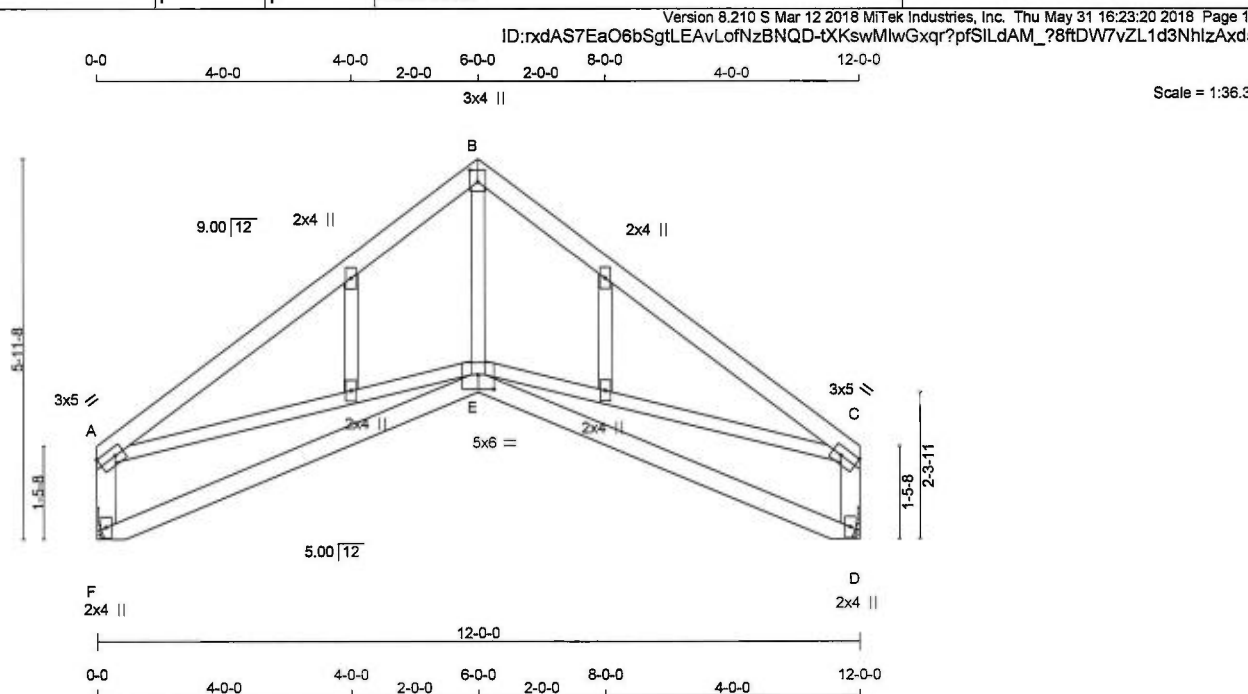

TOTAL WEIGHT = 50 LB

[M/F]

LUMBER				
N. L. G. A.	RULES			
CHORDS	SIZE	LUMBER		DESCR.
A - B	2x4	DRY	No.2	SPF
B - C	2x4	DRY	No.2	SPF
F - A	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF
F - E	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

ALL GABLE WEBS 2x3 DRY No.2 SPF
DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2'-0"-0 OC.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A TMVW-t	MT20	3.0	5.0	1.50	Edge
B TTW+p	MT20	3.0	4.0	2.25	1.50
C TMVW-t	MT20	3.0	5.0	1.50	Edge
D BMV1+p	MT20	2.0	4.0		
E BBWWW-p	MT20	5.0	6.0	2.75	3.00
F BMV1+p	MT20	2.0	4.0		
G H, I, J					
G NP+w	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT HORZ	DOWN HORZ	UPLIFT IN-SX	IN-SX
F	569 0	569 0	0	MECHANICAL
D	569 0	569 0	0	MECHANICAL

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT F, D TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	SNOW	MAX./MIN. LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	399	279 / 0	0 / 0	0 / 0	0 / 0	120 / 0	0 / 0
D	399	279 / 0	0 / 0	0 / 0	0 / 0	120 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

C H O R D S				W E B S			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. (PLF)	FACTORED DEAD LOAD CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	-645 / 0	-77.4	-77.4 0.37 (1)	6.25	E-B	0 / 310	0.07 (1)
B-C	-645 / 0	-77.4	-77.4 0.37 (1)	6.25	A-E	0 / 526	0.12 (1)
F-A	-517 / 0	0.0	0.0 0.05 (1)	7.81	E-C	0 / 526	0.12 (1)
D-C	-517 / 0	0.0	0.0 0.05 (1)	7.81			
F-E	0 / 0	-17.5	-17.5 0.18 (4)	10.00			
E-D	0 / 0	-17.5	-17.5 0.18 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3 PSF
	DL	=	3.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.0 PSF
TOTAL LOAD	=	33.3 PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.40")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.40")
CALCULATED VERT. DEFL.(TL) = L/999 (0.08")

CSI: TC=0.37/1.00 (A-B:1), BC=0.18/1.00 (D-E:4) , WB=0.12/1.00 (A-E:1) , SS=0.14/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES


PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**




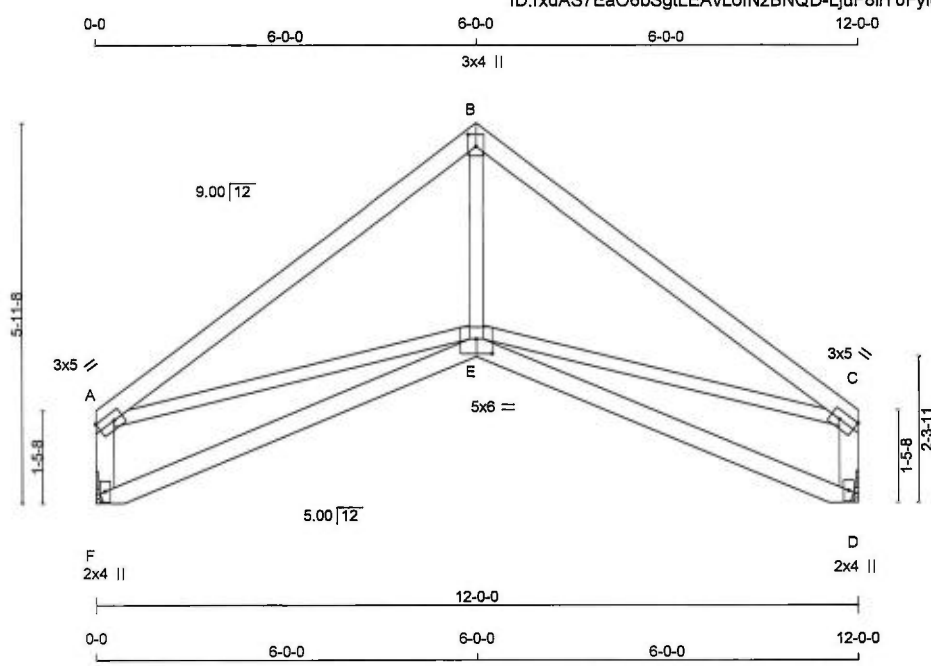

Scale = 1:36.3

TOTAL WEIGHT = 47 lb
[M][F]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF
B - C	2x4	DRY	No.2	SPF
F - A	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF
F - E	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
DRY: SEASONED LUMBER.				

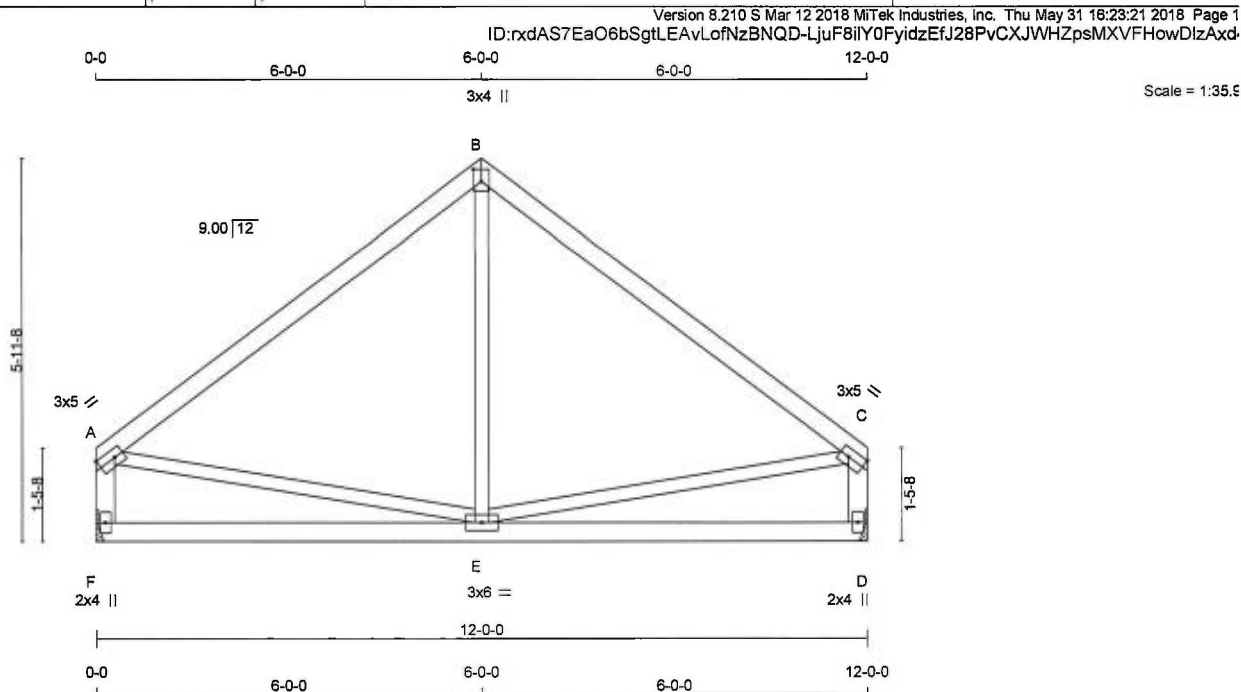

TOTAL WEIGHT = 47 lb (M)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF	
B - C	2x4	DRY	No.2	SPF	
F - A	2x4	DRY	No.2	SPF	
D - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	3.0	5.0	1.50	Edge
B	TTW+p	MT20	3.0	4.0	2.25	1.50
C	TMVW-t	MT20	3.0	5.0	1.50	Edge
D	BMV1+p	MT20	2.0	4.0		
E	BMVWW-t	MT20	3.0	6.0		
F	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
F	569	0	569	0
D	569	0	569	0

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT F, D TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS	DEAD	SOIL
F	399	279 / 0	0 / 0	0 / 0
D	399	279 / 0	0 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MEMB.	FORCE	MAX. FACTORED	MEMB.	FORCE	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD	LC1	MAX	MEMB.	FORCE	MAX	MEMB.
FR-TO	(LBS)	(PLF)	CSI (LC)	UNBRAC	FR-TO	(LBS)	CSI (LC)	UNBRAC
A-B	-396 / 0	-77.4	-77.4	0.36 (1)	6.25	E-B	0 / 107	0.04 (4)
B-C	-396 / 0	-77.4	-77.4	0.36 (1)	6.25	A-E	0 / 322	0.07 (1)
F-A	-529 / 0	0.0	0.0	0.05 (1)	7.81	E-C	0 / 322	0.07 (1)
D-C	-529 / 0	0.0	0.0	0.05 (1)	7.81			
F-E	0 / 0	-17.5	-17.5	0.18 (4)	10.00			
E-D	0 / 0	-17.5	-17.5	0.18 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.40")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.40")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.36/1.00 (A-B:1), BC=0.18/1.00 (D-E:4), WB=0.07/1.00 (A-E:1), SSI=0.14/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.70 (E) (INPUT = 0.90)
JSI METAL= 0.16 (C) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.





BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B37579H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-09, section 10.9.4.1.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately $1/3$ the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry ($< 19\%$ moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-09, section 10.9.4
10. This design is not valid after April 30, 2019.

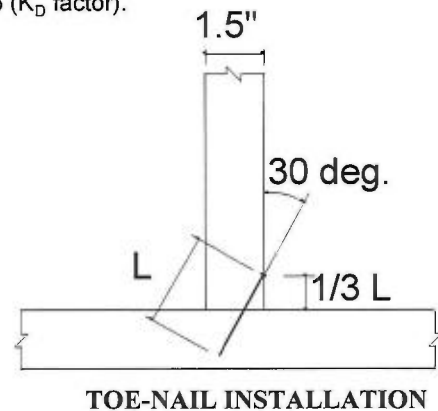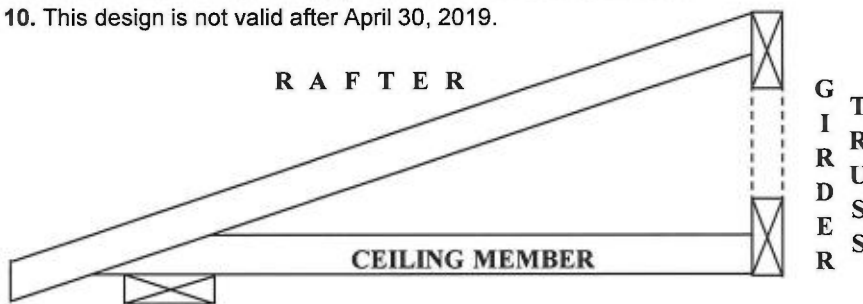

Nail type	Common wire	Common spiral	Common wire
Nail dia. (in)	0.160	0.152	0.144
	(3.5" nail)		(3" and 3.25" nail)
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS		
2X4 SPF	2	2	3
2X4 D. Fir	2	2	2
2X6 SPF	4	4	4
2X6 D. Fir	3	3	3



MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

PEO
Certificate No. 10889485



April 26, 2017

BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B37579H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind or earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-09, section 10.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-09, section 10.9.5
9. This design is not valid after April 30, 2019

Toe-nailing on 2x6 Bearing Plate

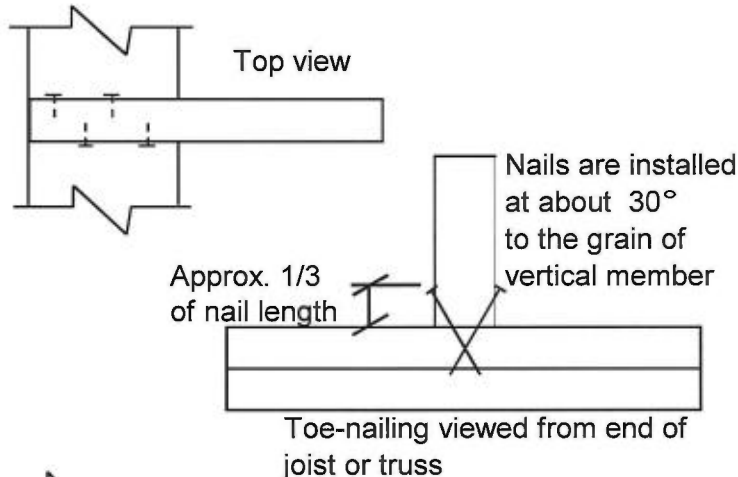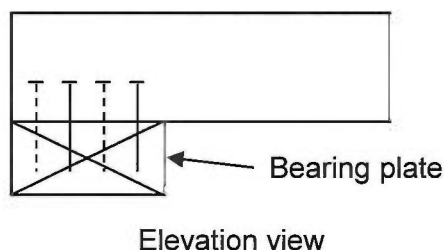

Toe-nailing on 2x4 Bearing Plate

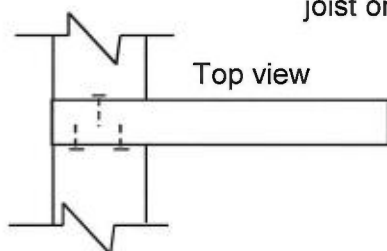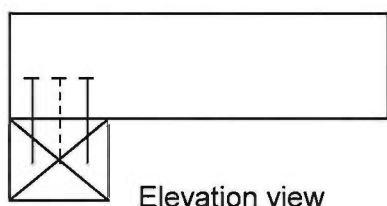

MiTek Canada Inc
100 Industrial Rd.
Bradford Ontario L3Z 3G7

PEO
Certificate No. 10889485



April 26, 2017