

ENGINEERING NOTE PAGE (ENP-1)
PLEASE READ PRIOR TO INSTALLATION

NE0618-001
GREEN YORK HOMES - GRANELLI
HOME CORP - LIANA 2 ELEV 1

RESPONSIBILITIES

THIS DESIGN IS FOR AN INDIVIDUAL BUILDING COMPONENT AND HAS BEEN BASED ON INFORMATION PROVIDED BY THE DESIGN OFFICE OF KOTT LUMBER. THE UNDERSIGNED ENGINEER DISCLAIMS ANY RESPONSIBILITY FOR DAMAGES AS A RESULT OF FAULTY OR INCORRECT INFORMATION, SPECIFICATION AND/OR DESIGNS FURNISHED TO THE ENGINEER. THE UNDERSIGNED ENGINEER IS ONLY RESPONSIBLE FOR THE STRUCTURAL INTEGRITY OF THIS BUILDING COMPONENT FOR THE CONDITIONS AND LOADS SHOWN ON THIS DRAWING. THE STRUCTURAL INTEGRITY OF THE BUILDING AND THE VERIFICATION OF THE DIMENSIONS AND THE DESIGN LOADS USED ARE THE RESPONSIBILITY OF THE BUILDING DESIGNER.

TRUSSES ARE DESIGNED IN CONFORMANCE WITH THE RELEVANT SECTIONS OF THE NATIONAL BUILDING CODE OF CANADA OR THE CANADIAN CODE FOR FARM BUILDINGS, WHICHEVER APPLIES TO THE BUILDING TYPE INDICATED ON THE DRAWING

IT IS THE RESPONSIBILITY OF KOTT LUMBER TO ENSURE THAT TRUSSES ARE MANUFACTURED IN CONFORMANCE WITH THESE DESIGNS AND WITH THE SPECIFICATIONS OUTLINED BELOW. THE UNDERSIGNED ENGINEER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

USE AND OCCUPANCY

- The building is of the type indicated on the drawing

**For conventional framing roof / ceilings
framing shall conform to OBC.9.23**

LOADING

- The truss loading intensity and distribution as well as load transfer mechanism is that indicated on the drawing
- No buildings, trees, parapets or other projections higher than the roof for which the trusses are used are located within a distance less than ten (10) times the difference in height, or five metres (16 ft) whichever is greater, unless the drawing indicates that the snow drifting has been taken into account

HANDLING, INSTALLATION AND BRACING

- The trusses must be handled and installed by a qualified professional as per the supplied document titled *Information for Truss Installers* and the BCSI-B1 and BCSI-B3 Summary Sheets
- The compression chords are laterally braced by continuous rigid diaphragm sheathing or as specified on the drawing
- Temporary and permanent bracing must be installed as indicated on the truss drawing and according to the BCSI-B1 and BCSI-B3 Summary Sheets. Bracing for the lateral stability of the truss is to be provided by the building designer
- **It is recommended that a Professional Engineer's advice be obtained for the bracing of trusses spanning more than 12.37m (40'-7")**

SUPPORTS

- The trusses are to be supported at the bearing points indicated and anchored to the supports where considered necessary by the designer of the overall structure
- Bearing sizes shown are the minimum required to prevent crushing of the truss members and do not necessarily take into account stability of the overall building structure
- Elevation of bearings must be carefully checked and shimmed to alignment for solid bearings
- Adequate wood truss bearing is the responsibility of the building designer.

DIMENSIONS


- Geometry of the truss and dimensions indicated on the drawing are identical to those of the installed truss.

THIS CERTIFICATION IS FOR THE ENGINEERING REVIEW OF STRUCTURAL COMPONENTS SHOWN ON THIS DRAWING AND IS LIMITED TO THE COMPONENTS SUPPLIED BY KOTT LUMBER FOR THE LOADS AND CONDITIONS SHOWN ON THE CALCULATION PAGE OF EACH COMPONENT. THE PLACEMENT OF THESE COMPONENTS ON THIS LAYOUT IS SHOWN FOR REFERENCE ONLY. ROOF TRUSSES MUST BE INSTALLED ACCORDING TO MANUFACTURER'S GUIDELINES AT 24" C/C UNLESS NOTED OTHERWISE. CONVENTIONAL FRAMING SHOWN ON THE LAYOUT MUST BE DESIGNED AND APPROVED BY THE PROJECT ENGINEER. TEMPORARY AND PERMANENT BRACINGS OF THE ROOF AND BUILDING ARE THE RESPONSIBILITY OF THE PROJECT ENGINEER AND TO CONFORM TO BCSI GUIDELINES.



All work shall conform to the Ontario Building Code O. Reg. 332/12 as amended

For conventional framing roof / ceilings
framing shall conform to OBC.9.29

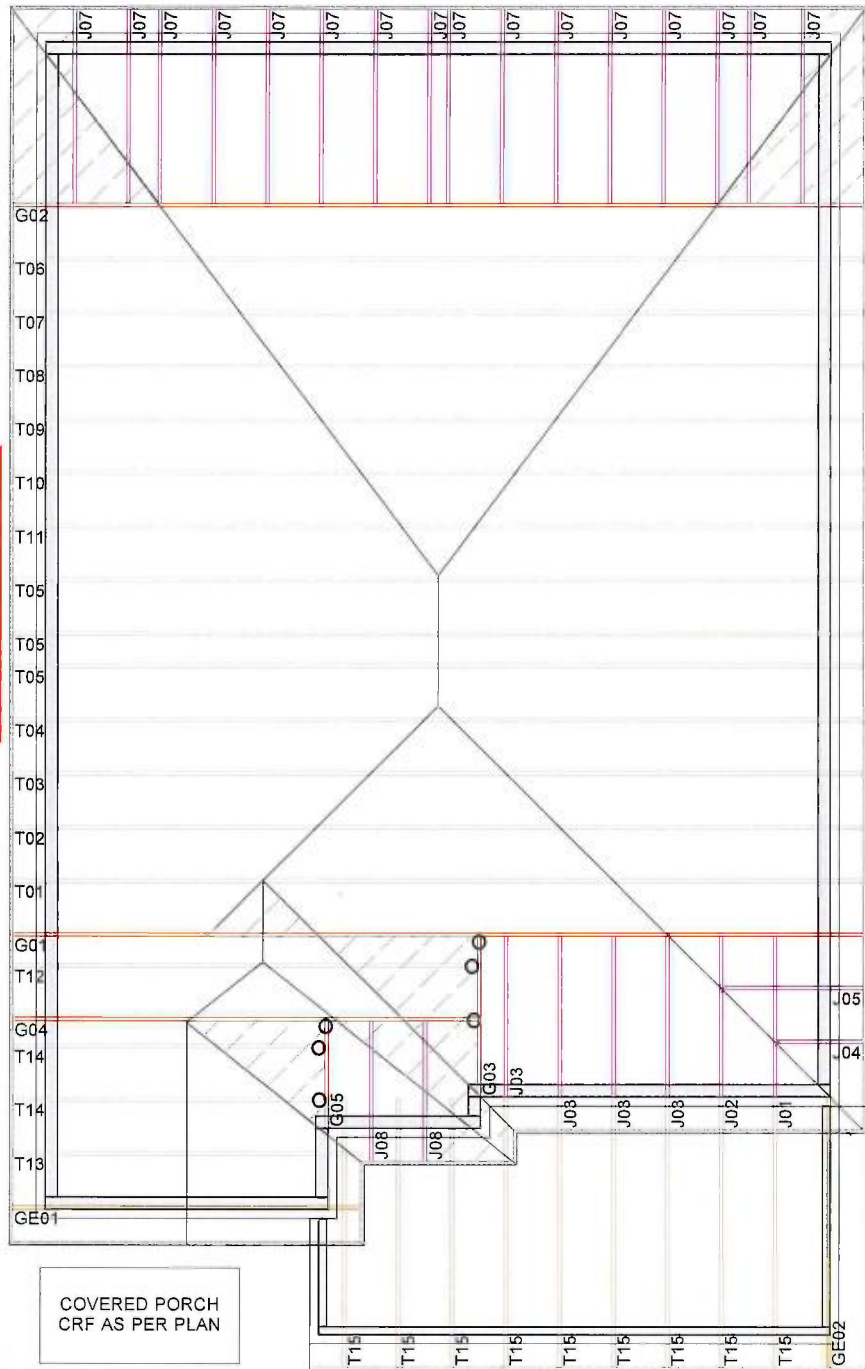

GARAGE TOP OF PLATE
TO MATCH UNDERSIDE
OF SOFFIT

ROOF TRUSS LAYOUT



CONVENTIONAL FRAMING BY OTHERS

ALL CONVENTIONAL FRAMING TO CONFORM WITH PART 9 OF THE O.B.C RAFTER THAT CROSS MEET OVER TRUSSES TO BE 2X4 SPF @ 24" O/C WITH 2X4 VERT POST TO THE TRUSS BELOW EA CROSS PT. VERT POS. THAN 6" TO HAVE A LATERAL BRACING SO THAT THE DISTANCE BETEN PT & VERT ROWS OF BRACING DOES NOT EXCEED 6'

X - LUS24 **O - LJS26DS**
- HGUS26 **% - HGUS26-2**

DESIGN CRITERIA
SPECIFIED LOADS

TOP CH, LL	=	23.3 psf
DL	=	3.0 psf
BOT CH, LL	=	0.0 psf
DL	=	7.0 psf
TOTAL LOAD	=	33.3 psf

SPACING @ 24" CENTERS,
THIS TRUSS SYSTEM IS DESIGN FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH PART 9 OF OBC 2012,
BCBC 2012, ABC 2012, CSA 086-09, TPIC 2011

ALLOWABLE DEFLECTION OF EACH COMPONENT = $L/360$

Model:	LIANA 2 ELE-1
Customer:	GREEN YORK HOMES

Project:	GRANELLI HOME
-----------------	----------------------

Location:	BRAMPTON, ON
------------------	---------------------

Drawn By:	DM
------------------	-----------

Date:	5/30/2018
--------------	------------------

MAR 05 2019

BY
ELE-1
FRENETTE
WORK HOMES



Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

WB - INDICATES BLOCKING REQUIRED

BEARINGS							
FACTORED GROSS REACTION			MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
V	2442	0	2442	0	0	5-8	5-8
M	3055	0	3055	0	0	5-8	5-8

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.33 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
I	23-2-0	-348	-348	—	FRONT	VERT	TOTAL
Q	16-1-4	-1514	-1514	—	FRONT	VERT	TOTAL

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED
BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.3	PSF
TOTAL LOAD	=	33.6	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A
SLOPE OF 2.00/12 MINIMUM

GIRDER TYPE: CPrimeHlp
SIDE SETBACK = 6-0-0
END SETBACK = 6-0-0
END WALL WIDTH = 5-8
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO FRONT SIDE
- ADDTL LOADS BASED ON 55 % OF GSL.
LOADS APPLIED TO FIRST 12-6-0 OF SPAN
MEASURED FROM THE RIGHT.

*** NON STANDARD GIRDER ***
ADDT'L USER-DEFINED LOADS APPLIED TO
ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD


ALLOWABLE DEFL.(LL) = $L/360$ (0.97")
 CALCULATED VERT. DEFL.(LL) = $L/999$ (0.20")
 ALLOWABLE DEFL.(TL) = $L/360$ (0.97")
 CALCULATED VERT. DEFL.(TL) = $L/977$ (0.36")

CSI: TC=0.83/1.00 (F-H:1), BC=0.66/1.00 (P-R:1),
WB=0.74/1.00 (K-N:1), SSI=0.75/1.00 (P-R:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

CONTINUED ON PAGE 2

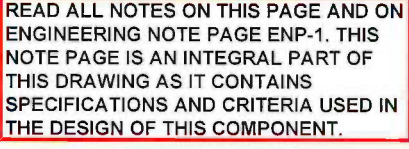

HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S)
REQUIRED TO SUPPORT CONCENTRATED
LOAD(S) 348.1 lbs FACTORED DOWN AT 23-2-0
ON TOP CHORD, AND 1514.4 lbs FACTORED
DOWN AT 16-1-4 ON BOTTOM CHORD. DESIGN
FOR UNSPECIFIED CONNECTION(S) IS
DELEGATED TO THE BUILDING DESIGNER.

TRUSS PLATE MANUFACTURER IS NOT
RESPONSIBLE FOR QUALITY CONTROL IN
THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (I) (INPUT = 0.90)
JSI METAL= 0.95 (Q) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



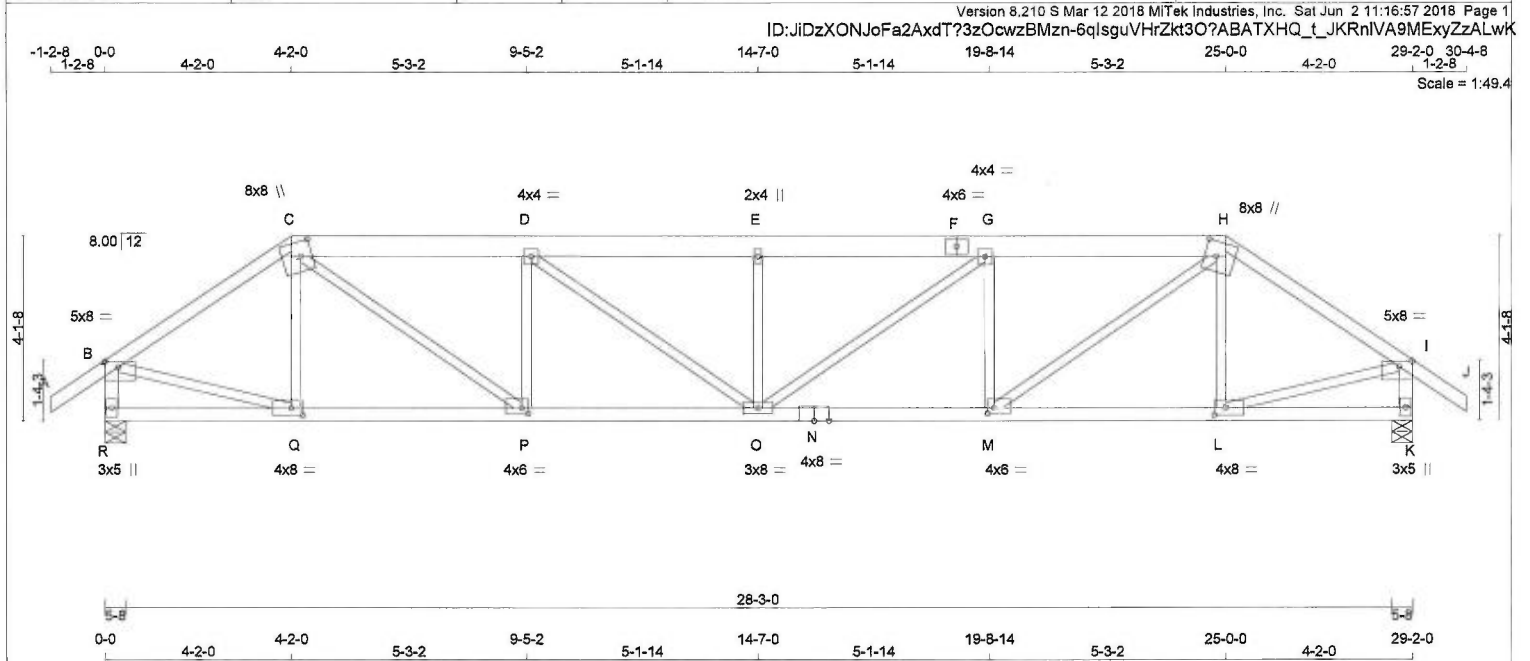

Version 8.210 S Mar 12 2018 MITek Industries, Inc. Sat Jun 2 11:16:57 2018 Page 1
ID:JiDzXONJoFa2AxdT?3zOcwzBMzn-6qlsguVHrZktO?ABATXHQt_JKRnIvA9MExyZzALwK
Scale = 1:49.4

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQRD	SPECIFIED LOADS:	
A - C	2x4	DRY	No.2	SPF		GROSS REACTION	GROSS REACTION	BRG	BRG	TOP CH. LL = 23.3 PSF	
C - F	2x6	DRY	No.2	SPF		VERT	DOWN	HORIZ	UPLIFT	DL = 3.0 PSF	
F - H	2x4	DRY	No.2	SPF		R	2685	0	2685	BOT CH. LL = 0.0 PSF	
H - J	2x4	DRY	No.2	SPF		K	2685	0	2685	DL = 7.3 PSF	
R - B	2x4	DRY	No.2	SPF						TOTAL LOAD = 33.6 PSF	
K - I	2x4	DRY	No.2	SPF							
R - N	2x4	DRY	No.2	SPF							
N - K	2x4	DRY	No.2	SPF							
ALL WEBS	2x3	DRY	No.2	SPF							
EXCEPT											
DRY: SEASONED LUMBER.											

UNFACTORED REACTIONS
1ST LCASE MAX/MIN. COMPONENT REACTIONS
JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL
R 1885 1314 / 0 0 / 0 0 / 0 0 / 0 571 / 0 0 / 0
K 1885 1314 / 0 0 / 0 0 / 0 0 / 0 571 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K
BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.44 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX LC1 MAX CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 28	-77.4 -77.4	0.10 (1)	10.00	Q-C	-449 / 13	0.11 (1)
B-C	-3149 / 0	-77.4 -77.4	0.46 (1)	3.52	C-P	0 / 2539	0.63 (1)
C-D	-4678 / 0	-145.9 -145.9	0.43 (1)	3.63	P-D	-1309 / 0	0.33 (1)
D-E	-5289 / 0	-145.9 -145.9	0.43 (1)	3.44	D-O	0 / 757	0.19 (1)
E-F	-5289 / 0	-145.9 -145.9	0.43 (1)	3.44	O-E	-711 / 0	0.18 (1)
F-G	-5289 / 0	-145.9 -145.9	0.43 (1)	3.44	O-G	0 / 757	0.19 (1)
G-H	-4678 / 0	-145.9 -145.9	0.43 (1)	3.63	M-G	-1309 / 0	0.33 (1)
H-I	-3149 / 0	-77.4 -77.4	0.46 (1)	3.52	M-H	0 / 2539	0.63 (1)
I-J	0 / 28	-77.4 -77.4	0.10 (1)	10.00	L-H	-449 / 13	0.11 (1)
R-B	-2628 / 0	0.0 0.0	0.30 (1)	5.23	B-Q	0 / 2703	0.67 (1)
K-I	-2628 / 0	0.0 0.0	0.30 (1)	5.23	L-I	0 / 2703	0.67 (1)
R-Q	0 / 0	-34.4 -34.4	0.19 (4)	10.00			
Q-P	0 / 2616	-34.4 -34.4	0.57 (1)	10.00			
P-O	0 / 4678	-34.4 -34.4	0.92 (1)	10.00			
O-N	0 / 4678	-34.4 -34.4	0.92 (1)	10.00			
N-M	0 / 4678	-34.4 -34.4	0.92 (1)	10.00			
M-L	0 / 2616	-34.4 -34.4	0.57 (1)	10.00			
L-K	0 / 0	-34.4 -34.4	0.19 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)
JT LOC. LC1 MAX- MAX+ FACE DIR. TYPE
C 4-2-0 -242 -242 -- FRONT VERT TOTAL
H 25-0-0 -242 -242 -- FRONT VERT TOTAL

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2264 1656


CONTINUED ON PAGE 2



PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.89 (P) (INPUT = 0.90)
JSI METAL= 0.90 (N) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



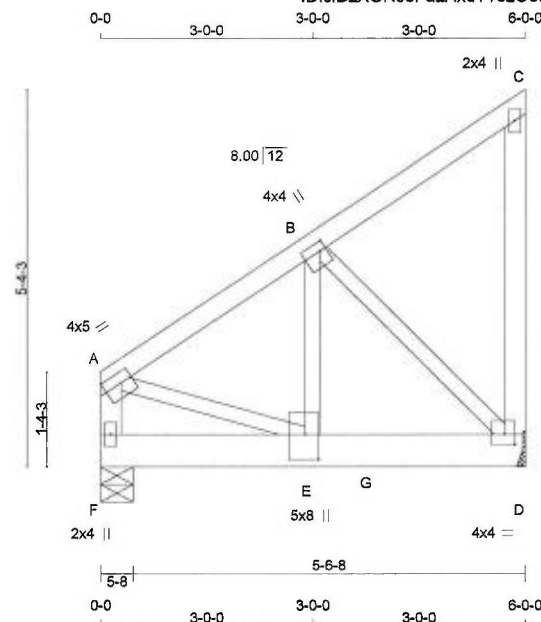

Scale = 1:31.4

TOTAL WEIGHT = 33 lb

LUMBER				DESCR.	
N. L. G. A. RULES					
CHORDS	SIZE	LUMBER		SPF	
A - C	2x4	DRY	No.2	SPF	
D - C	2x4	DRY	No.2	SPF	
F - A	2x4	DRY	No.2	SPF	
F - D	2x6	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
DRY: SEASONED LUMBER.					

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW+	MT20	4.0	5.0	1.75 Edge
B	TMVW+	MT20	4.0	4.0	1.50 1.00
C	TMV+p	MT20	2.0	4.0	
D	BMVW1+	MT20	4.0	4.0	1.75 1.75
E	BMVW+	MT20	5.0	8.0	4.25 2.25
F	BMV1+p	MT20	2.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES

- SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 1300.9 lbs FACTORED DOWN AT 2-10-12 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	VERT	HORZ	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
			DOWN	HORZ	DOWN	HORZ	IN-SX	IN-SX
D	1514	0	1514	0	0	0	MECHANICAL	
F	1064	0	1064	0	0	0	5-8	5-8

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT D TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	COMBINED	1ST LCASE MAX./MIN. COMPONENT REACTIONS					DEAD	SOIL
		SNOW	LIVE	PERM.LIVE	WIND			
D	1064	737 / 0	0 / 0	0 / 0	0 / 0		326 / 0	0 / 0
F	748	518 / 0	0 / 0	0 / 0	0 / 0		229 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.78 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS				WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	LC1 MAX (PLF)	LC1 MAX (CSI (LC))	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)	LC1 MAX (PLF)	LC1 MAX (CSI (LC))
FR-TO								
A-B	-1147 / 0	-77.4	-77.4	0.12 (1)	5.78	0 / 1312	0.32 (1)	
B-C	-13 / 0	-77.4	-77.4	0.10 (1)	6.25	B-D -1352 / 0	0.39 (1)	
D-C	-93 / 0	0.0	0.0	0.04 (1)	7.81	A-E	0 / 1012	0.25 (1)
F-A	-1040 / 0	0.0	0.0	0.12 (1)	7.68			
F-E	0 / 0	-18.2	-18.2	0.02 (4)	10.00			
E-G	0 / 965	-18.2	-18.2	0.37 (1)	10.00			
G-D	0 / 965	-342.9	-342.9	0.37 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1 MAX-	LC1 MAX+	FACE	DIR.	TYPE
E	2-10-12	-1301	-1301	—	BACK	VERT

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
	DL = 3.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.3	PSF
TOTAL LOAD	= 33.6	PSF

SPACING = 24.0 IN. C/C

GIRDER TYPE: CStdGirder
START DISTANCE = 3-10-0
START SPAN CARRIED = 16-0-8
END DISTANCE = 6-0-0
END SPAN CARRIED = 16-0-8
END WALL WIDTH = 5-8
APPLIED TO BACK SIDE OF BOTTOM CHORD.
- ADDTL LOADS BASED ON 55 % OF GSL.
(DEFINED BY USER)

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.12/1.00 (A-B:1), BC=0.37/1.00 (D-E:1), WB=0.39/1.00 (B-D:1), SS=0.31/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

CONTINUED ON PAGE 2



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (B) (INPUT = 0.90)
JSI METAL= 0.36 (A) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



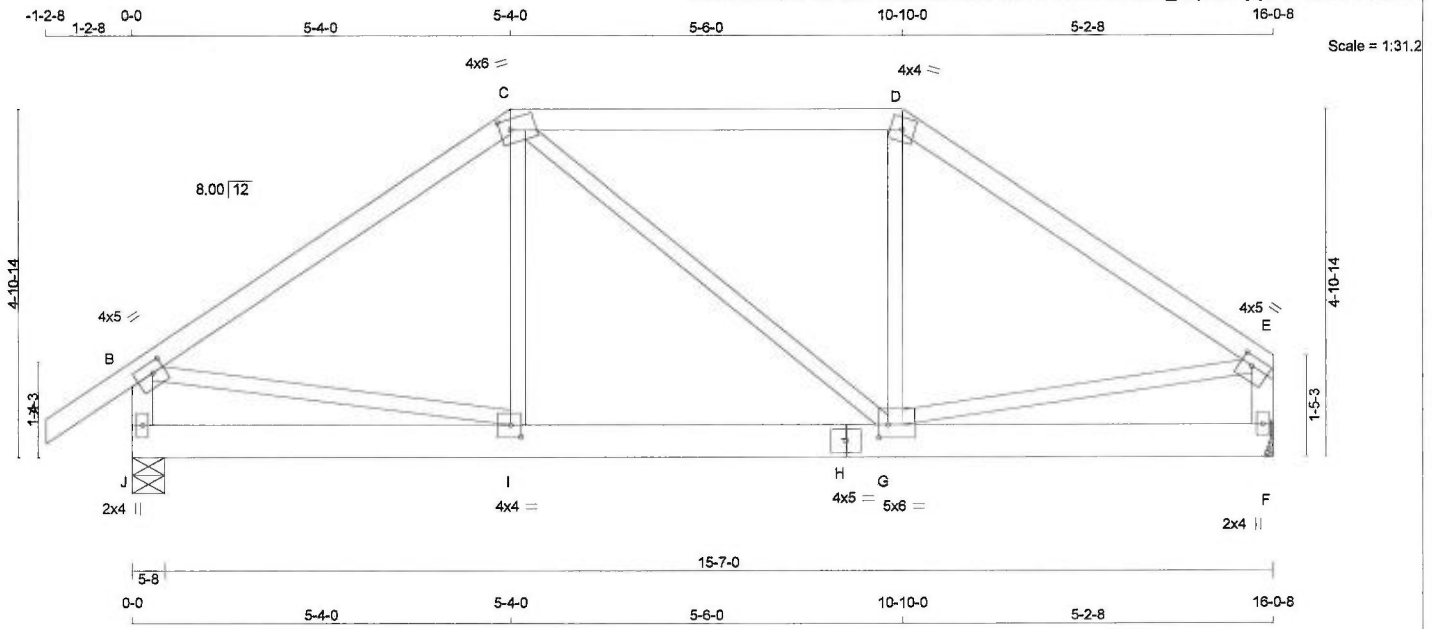

TOTAL WEIGHT = 74 lb [M]

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A -	2x4	DRY	No.2	SPF	
C -	2x4	DRY	No.2	SPF	
D -	2x4	DRY	No.2	SPF	
J -	2x4	DRY	No.2	SPF	
F -	2x4	DRY	No.2	SPF	
J -	2x6	DRY	No.2	SPF	
H -	2x6	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	5.0	1.75 2.00
C	TTWW-m	MT20	4.0	6.0	1.75 1.75
D	TTW-m	MT20	4.0	4.0	
E	TMVW-t	MT20	4.0	5.0	1.50 2.00
F	BMV1+p	MT20	2.0	4.0	
G	BMWWW-t	MT20	5.0	6.0	2.25 1.50
H	BS-t	MT20	4.0	5.0	
I	BMWW-t	MT20	4.0	4.0	2.00 1.75
J	BMV1+p	MT20	2.0	4.0	

HANGERS NOTES

- SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 187.9 lbs FACTORED DOWN AT 10-10-0 ON TOP CHORD, AND 585.0 lbs FACTORED DOWN AT 10-5-4 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REQRD
JT	VERT	HORZ	DOWN	HORZ
J	1124	0	1124	0
F	1300	0	1300	0

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT F TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

	1ST LCASE	MAX./MIN.	COMPONENT REACTIONS			
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
J	787	562 / 0	0 / 0	0 / 0	0 / 0	225 / 0
F	914	631 / 0	0 / 0	0 / 0	0 / 0	283 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.82 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 28	-77.4	-77.4 0.10 (1)	I-C	-50 / 68	0.03 (4)	
B-C	-1107 / 0	-77.4	-77.4 0.48 (1)	C-G	0 / 381	0.09 (1)	
C-D	-1209 / 0	-77.4	-77.4 0.50 (1)	G-D	0 / 222	0.07 (4)	
D-E	-1444 / 0	-77.4	-77.4 0.48 (1)	B-I	0 / 934	0.23 (1)	
J-B	-1082 / 0	0.0	0.0 0.12 (1)	G-E	0 / 1222	0.30 (1)	
F-E	-1234 / 0	0.0	0.0 0.14 (1)				
J-I	0 / 0	-18.2	-18.2 0.06 (4)				
I-H	0 / 919	-18.2	-18.2 0.15 (1)				
H-G	0 / 919	-18.2	-18.2 0.15 (1)				
G-F	0 / 0	-25.3	-25.3 0.09 (4)				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
D	10-10-0	-168	-168	-	FRONT	VERT	TOTAL
G	10-5-4	-585	-585	-	FRONT	VERT	TOTAL

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
	DL = 3.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.3	PSF
TOTAL LOAD	= 33.6	PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

GIRDER TYPE: CPrimeHip
LEFT SETBACK = 5-4-0
RIGHT SETBACK = 5-2-8
END SETBACK = 4-0-0
END WALL WIDTH = 5-8
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO FRONT SIDE
- ADDTL LOADS BASED ON 55 % OF GSL.
LOADS APPLIED TO FIRST 5-2-8 OF SPAN MEASURED FROM THE RIGHT.

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.53")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.53")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.50/1.00 (C-D:1), BC=0.15/1.00 (G-I:1), WB=0.30/1.00 (E-G:1), SSI=0.18/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

CONTINUED ON PAGE 2



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX MIN
MT20	618	354 1667	822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (G) (INPUT = 0.90)

JSI METAL= 0.47 (E) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



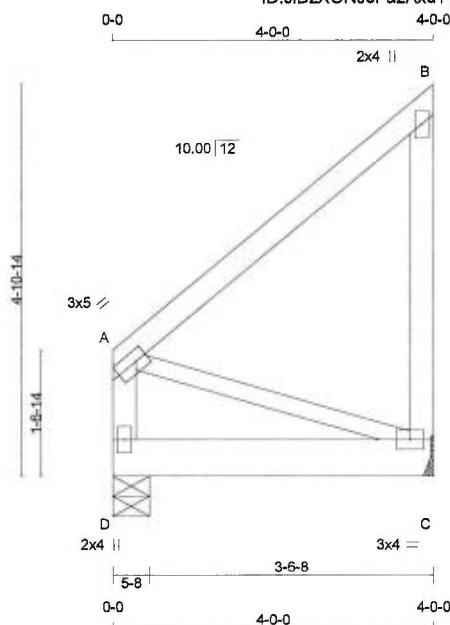

Scale = 1:27.7

TOTAL WEIGHT = 22 lb

LUMBER		LUMBER		DESCR.	
N. L. G. A. RULES					
CHORDS	SIZE				
A - B	2x4	DRY	No.2		SPF
C - B	2x4	DRY	No.2		SPF
D - A	2x4	DRY	No.2		SPF
D - C	2x6	DRY	No.2		SPF
ALL WEBS	2x3	DRY	No.2		SPF
DRY: SEASONED LUMBER.					

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	3.0	5.0	1.50	1.75
B	TMV+p	MT20	2.0	4.0		
C	BMVW1-t	MT20	3.0	4.0		
D	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT	REQRD
	GROSS REACTION		GROSS REACTION			BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
C	586	0	586	0	0	MECHANICAL	
D	586	0	586	0	0	5-B	5-B

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT C TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
C	411	285 / 0	0 / 0	0 / 0	0 / 0	126 / 0	0 / 0
D	411	285 / 0	0 / 0	0 / 0	0 / 0	126 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

LOADING
TOTAL LOAD CASES: (4)

C H O R D S				W E B S			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 0	-77.4	-77.4	0.23 (1)			
C-B	-155 / 0	0.0	0.0	0.06 (1)	A-C	0 / 0	0.00 (1)
D-A	-155 / 0	0.0	0.0	0.02 (1)			
D-C	0 / 0	-215.4	-215.4	0.32 (1)			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.3	PSF
TOTAL LOAD =		33.6	PSF

DL	=	7.3	PSF
TOTAL LOAD	=	33.6	PSF

SPACING = 24.0 IN. C/C

GIRDER TYPE: CStdGirder

GIRDER TYPE: CStdGirder
START DISTANCE = 0-0
START SPAN CARRIED = 10-4-8

END DISTANCE = 4-0-0

END SPAN CARRIED = 10-4-8

END WALL WIDTH = 1-8

APPLIED TO BACK SIDE OF BOTTOM CHORD.

- ADDTL LOADS BASED ON 55 % OF GSL

- ADDITIONAL LOADS BASED
(DEFINED BY USER)

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.04")

CSI: TC=0.23/1.00 (A-B:1) , BC=0.32/1.00 (C-D:1) ,
WB=0.00/1.00 (A-C:1) , SS=0.29/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)		SHEAR		SECTION
	(PSI)		(PLI)		(PLI)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	618	354	1667	822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

CONTINUED ON PAGE 2



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT**




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
NE0618-001	G05	1	1	GREEN YORK HOMES - GRANELLI HOME CORP - LIANA 2 ELEV 1	PAGE 12 OF 38

Version 8.210 S Mar 12 2018 MITek Industries, Inc. Sat Jun 2 11:16:58 2018 Page 2
ID:JiDzXONJoFa2AxdT?3zOcwzBMzn-a0sEtEWvctskhYaMlt_mqdW6Gjq3WMBKO0zVU?zALw

JSI GRIP= 0.15 (C) (INPUT = 0.90)
JSI METAL= 0.04 (B) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



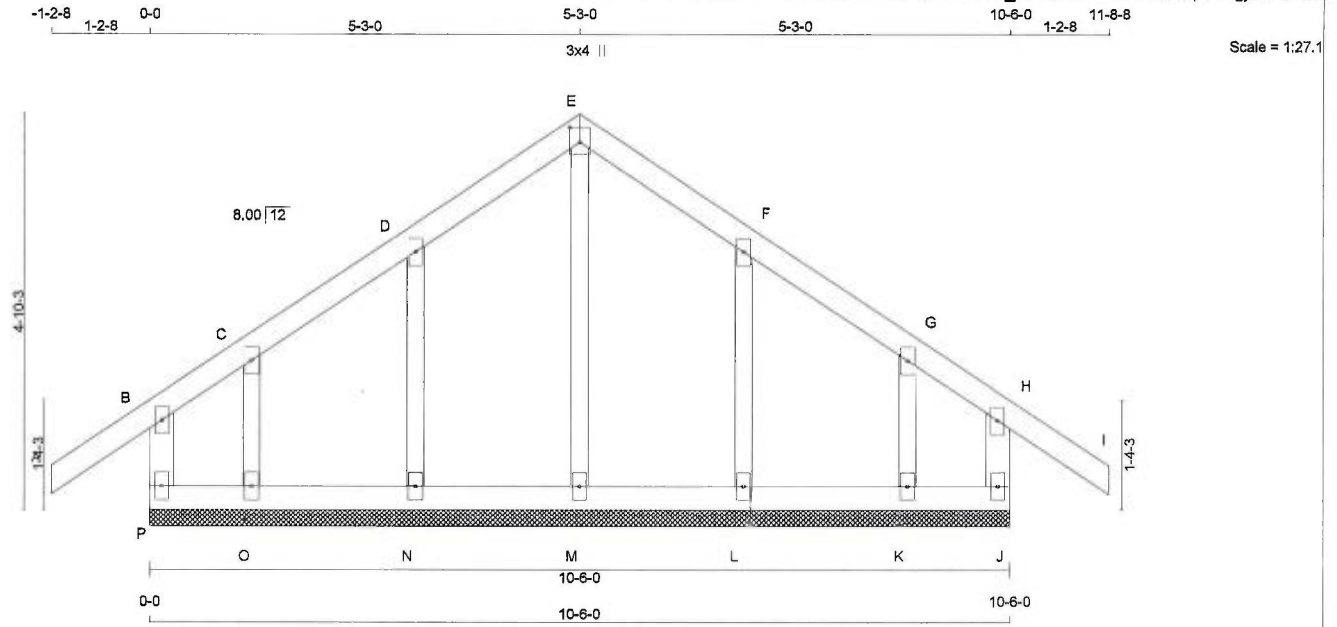

Scale = 1:27.1

LUMBER				DESCR.
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	
P - B	2x4	DRY	No.2	SPF
A - E	2x4	DRY	No.2	SPF
E - I	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
P - J	2x4	DRY	No.2	SPF
ALL WEBS 2x3 DRY No.2				SPF
ALL GABLE WEBS 2x3 DRY No.2				SPF
GABLE STUDS SPACED AT 2'-0" OC.				

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMV+p	MT20	2.0	4.0	
C, D, F, G				
C TMW+w	MT20	2.0	4.0	
E TTW+p	MT20	3.0	4.0	2.25 1.50
H TMV+p	MT20	2.0	4.0	
J BMV1+p	MT20	2.0	4.0	
K, L, M, N, O				
K BMW1+w	MT20	2.0	4.0	
P BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	FR-TO MAX CSI (LC)
FR-TO		FROM TO		FR-TO			
P-B	-158 / 0	0.0	0.0 0.03 (1)	M-E	-189 / 0		0.06 (1)
A-B	0 / 28	-77.4	-77.4 0.09 (1)	N-D	-167 / 0		0.03 (1)
B-C	0 / 8	-77.4	-77.4 0.06 (1)	O-C	-87 / 0		0.01 (1)
C-D	0 / 31	-77.4	-77.4 0.05 (1)	L-F	-167 / 0		0.03 (1)
D-E	0 / 29	-77.4	-77.4 0.05 (1)	K-G	-87 / 0		0.01 (1)
E-F	0 / 29	-77.4	-77.4 0.05 (1)				
F-G	0 / 31	-77.4	-77.4 0.05 (1)				
G-H	0 / 8	-77.4	-77.4 0.06 (1)				
H-I	0 / 28	-77.4	-77.4 0.09 (1)				
J-H	-158 / 0	0.0	0.0 0.03 (1)				
P-O	-18 / 0	-18.2	-18.2 0.01 (4)				
O-N	-22 / 0	-18.2	-18.2 0.02 (4)				
N-M	-26 / 0	-18.2	-18.2 0.02 (4)				
M-L	-26 / 0	-18.2	-18.2 0.02 (4)				
L-K	-22 / 0	-18.2	-18.2 0.02 (4)				
K-J	-18 / 0	-18.2	-18.2 0.01 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.
(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD
CSI: TC=0.09/1.00 (A-B:1), BC=0.02/1.00 (L-M:4), WB=0.06/1.00 (E-M:1), SS=0.06/1.00 (A-B:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10
COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.13 (E) (INPUT = 0.90)
JSI METAL= 0.06 (E) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



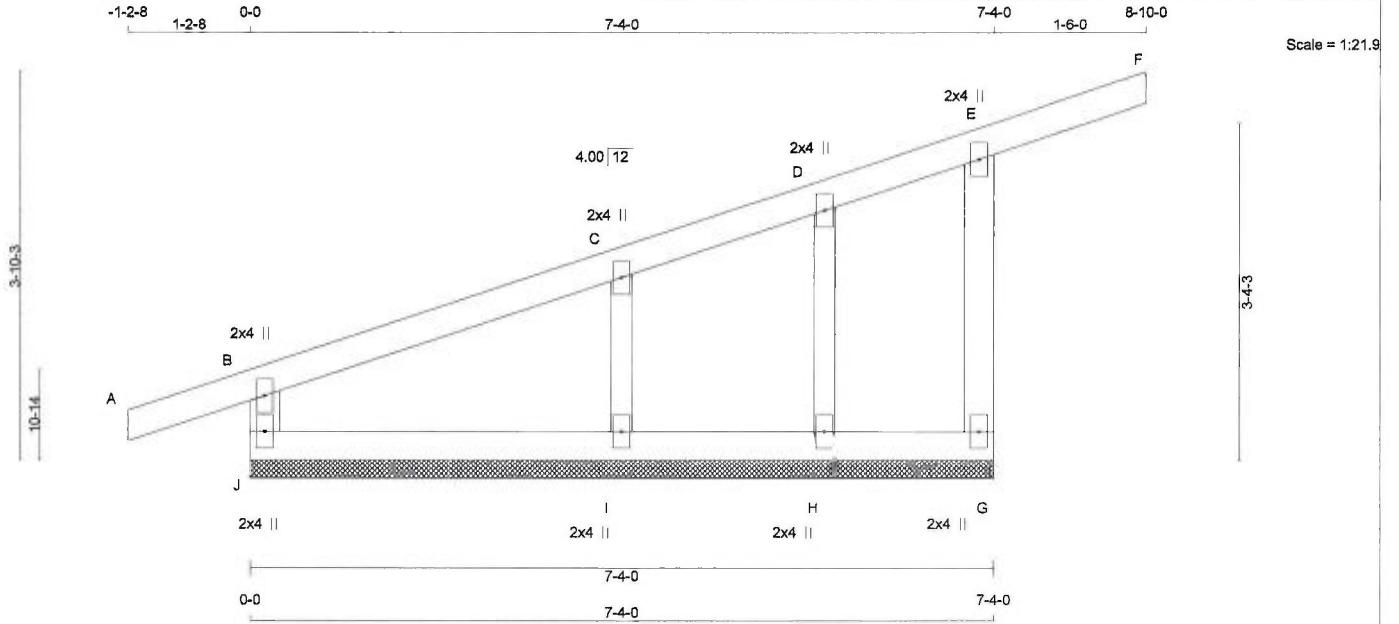

TOTAL WEIGHT = 27 lb [M]

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
J - B	2x4	DRY	No.2
A - F	2x4	DRY	No.2
G - E	2x4	DRY	No.2
J - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			
GABLE STUDS SPACED AT 2-0-0 OC.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	2.0	4.0	
C	TMW+w	MT20	2.0	4.0	
D	TMW+w	MT20	2.0	4.0	
E	TMV+p	MT20	2.0	4.0	
G	BMV1+p	MT20	2.0	4.0	
H	BMW1+w	MT20	2.0	4.0	
I	BMW1+w	MT20	2.0	4.0	
J	BMV1+p	MT20	2.0	4.0	

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)
FR-TO		FROM TO			FR-TO		
J-B	-245 / 0	0.0	0.0	0.03 (4)	7.81	I-C	-236 / 0
A-B	0 / 15	-77.4	-77.4	0.09 (1)	10.00	H-D	-78 / 0
B-C	-1 / 0	-77.4	-77.4	0.13 (1)	10.00		
C-D	-1 / 0	-77.4	-77.4	0.09 (1)	10.00		
D-E	0 / 23	-77.4	-77.4	0.09 (1)	10.00		
E-F	-19 / 0	-77.4	-77.4	0.13 (1)	6.25		
G-E	-225 / 0	0.0	0.0	0.04 (1)	7.81		
J-I	-3 / 1	-18.2	-18.2	0.04 (4)	10.00		
I-H	-9 / 0	-18.2	-18.2	0.04 (4)	10.00		
H-G	-11 / 0	-18.2	-18.2	0.01 (1)	6.25		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.13/1.00 (B-C:1), BC=0.04/1.00 (I-J:4), WB=0.04/1.00 (C-I:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
(PSI)	(PLI)	(PLI)	(PLI)		
	MAX	MIN	MAX	MIN	MAX
MT20	618	354	1667	822	2284

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.13 (B) (INPUT = 0.90)
JSI METAL= 0.05 (E) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



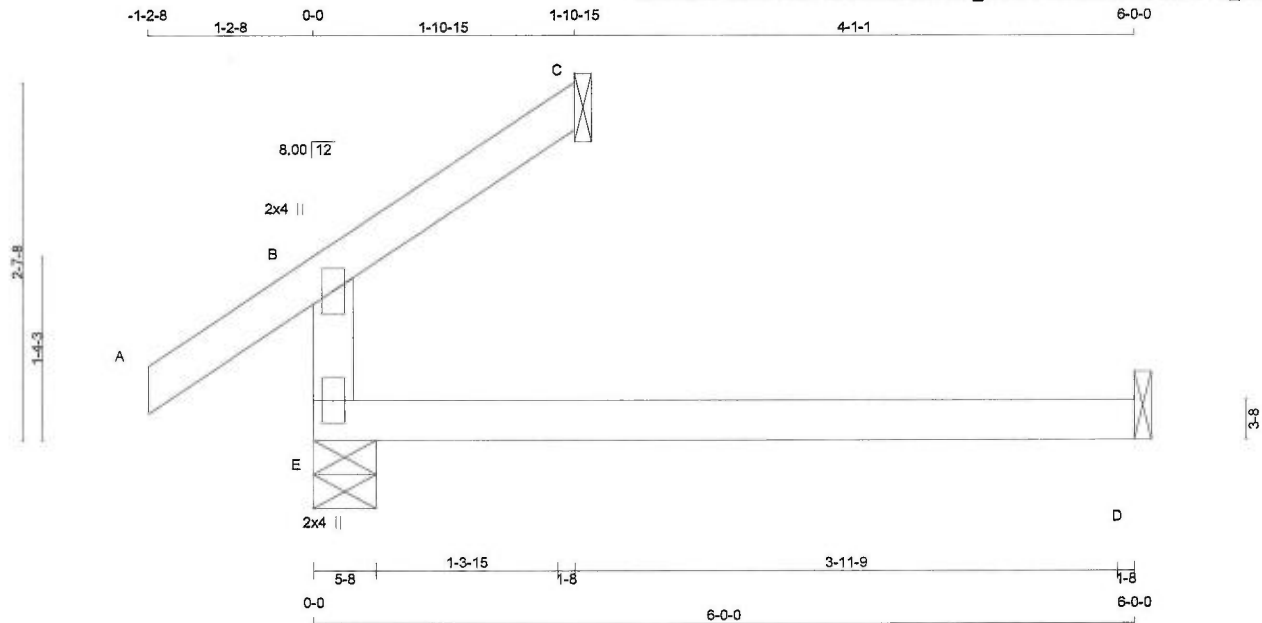

TOTAL WEIGHT = 12 lb
[M][F]

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	2.0	4.0	
E	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
E	255	0	255	0	5-8	5-8
C	56	0	56	0	1-8	1-8
D	46	0	51	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
E	181	115 / 0	0 / 0	0 / 0	0 / 0	66 / 0	0 / 0
C	38	34 / 0	0 / 0	0 / 0	0 / 0	4 / 0	0 / 0
D	37	0 / 0	0 / 0	0 / 0	0 / 0	37 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		WEBS	
	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (PLF)	MAX. UNBRACED LENGTH (LC)	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)
FR-TO		FROM	TO			
E-B	-192 / 0	0.0	0.0	0.11 (4)	7.81	
A-B	0 / 28	-77.4	-77.4	0.09 (1)	10.00	
B-C	-10 / 0	-77.4	-77.4	0.04 (1)	10.00	
E-D	0 / 0	-18.2	-18.2	0.13 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
	DL = 3.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.3	PSF
TOTAL LOAD	= 33.6	PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F., G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.11/1.00 (B-E:4), BC=0.13/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SSI=0.09/1.00 (D-E:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.12 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



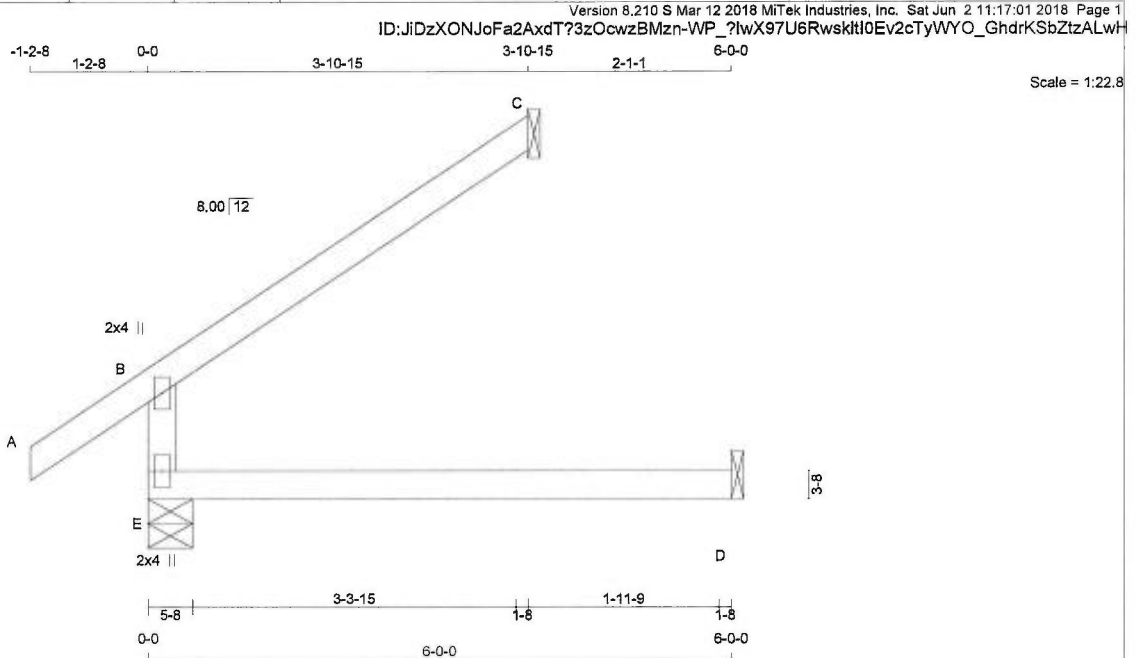

TOTAL WEIGHT = 15 lb
[M][F]

LUMBER				LUMBER	DESCR.
N. L. G. A. RULES	CHORDS	SIZE			
E - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	2.0	4.0	
E	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD IN-SX
	VERT	HORZ	DOWN	HORZ		
E	353	0	353	0	5-8	5-8
C	114	0	114	0	1-8	1-8
D	46	0	51	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN.	COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	247	174 / 0	0 / 0	0 / 0	0 / 0	73 / 0	0 / 0
C	77	68 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0
D	37	0 / 0	0 / 0	0 / 0	0 / 0	37 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH FR-TO	MAX. FACTORED CSI (LC)
FR-TO		FROM	TO	FR-TO			
E - B	-289 / 0	0.0	0.0 0.11 (4)	7.81			
A - B	0 / 28	-77.4	-77.4 0.09 (1)	10.00			
B - C	-21 / 0	-77.4	-77.4 0.15 (1)	6.25			
E - D	0 / 0	-18.2	-18.2 0.13 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
	DL = 3.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.3	PSF
TOTAL LOAD	= 33.6	PSF

SPACING = 24.0 IN. C/C

THIS DESIGN COMPLIES FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.15/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.19 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



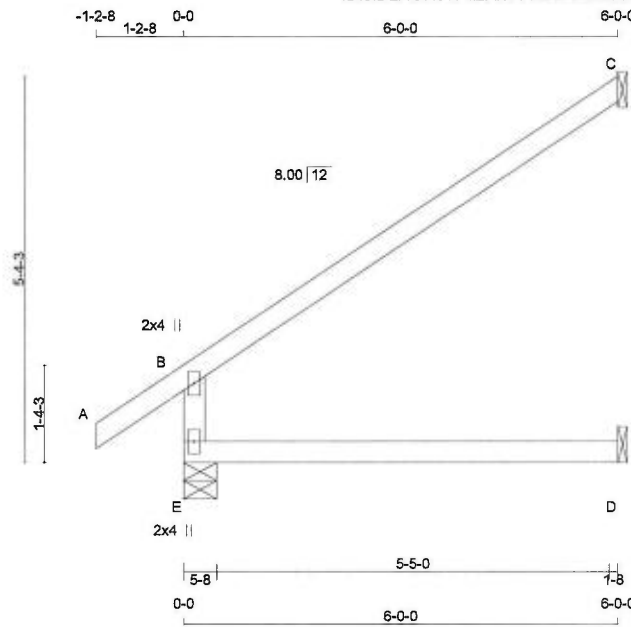

Scale = 1:30.7

TOTAL WEIGHT = 4 X 18 = 72 lb
(M)(F)

LUMBER				LUMBER	DESCR.
N. L. G. A. RULES	CHORDS	SIZE			
E - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	2.0	4.0	
E	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
E	454	0	454	0	5-8	5-8
C	174	0	174	0	1-8	1-8
D	46	0	51	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		PERM.LIVE	WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE					
E	316	235 / 0	0 / 0	0 / 0	0 / 0	0 / 0	81 / 0	0 / 0
C	118	105 / 0	0 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0
D	37	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	37 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 MAX (PLF)	MAX. FACTORED UNBRAC LENGTH FR-TO	MAX. FACTORED CSI (LC)
FR-TO		FROM TO		
E-B	-390 / 0	0.0 0.0 0.11 (4)	7.81	
A-B	0 / 28	-77.4 -77.4 0.09 (1)	10.00	
B-C	-32 / 0	-77.4 -77.4 0.36 (1)	6.25	
E-D	0 / 0	-18.2 -18.2 0.13 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
	DL = 3.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.3	PSF
TOTAL LOAD	= 33.6	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.04")

CSI: TC=0.36/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.19/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.25 (B) (INPUT = 0.90)
JSI METAL= 0.10 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



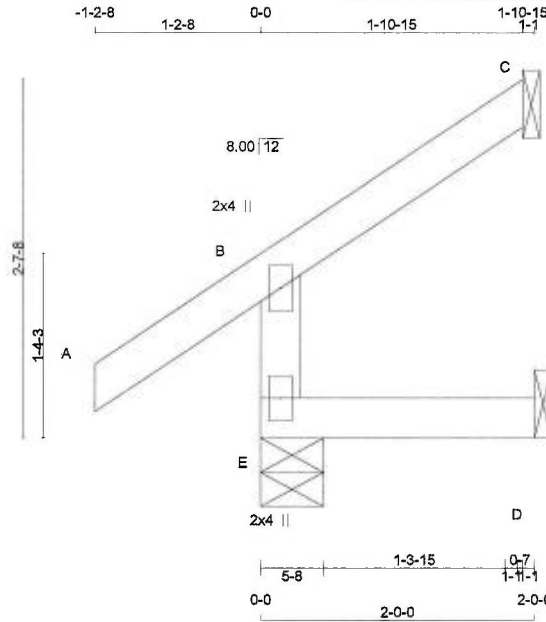

Scale = 1:16.2

TOTAL WEIGHT = 8 lb [M]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
E - B	2x4 DRY	No.2	SPF	
A - C	2x4 DRY	No.2	SPF	
E - D	2x4 DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	2.0	4.0	
E	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQRD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	212	0	212	0	5-8	5-8
C	56	0	56	0	1-8	1-8
D	16	0	18	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
E	146	115 / 0	0 / 0	0 / 0	0 / 0	31 / 0	0 / 0
C	38	34 / 0	0 / 0	0 / 0	0 / 0	4 / 0	0 / 0
D	13	0 / 0	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH FR-TO	MAX. FACTORED CSI (LC)
FR-TO		FROM TO		FR-TO			
E-B	-192 / 0	0.0	0.0 0.01 (4)	7.81			
A-B	0 / 28	-77.4	-77.4 0.09 (1)	10.00			
B-C	-10 / 0	-77.4	-77.4 0.05 (1)	10.00			
E-D	0 / 0	-18.2	-18.2 0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.3	PSF
TOTAL LOAD	=	33.6	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.09/1.00 (A-B:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SS=0.06/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.12 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



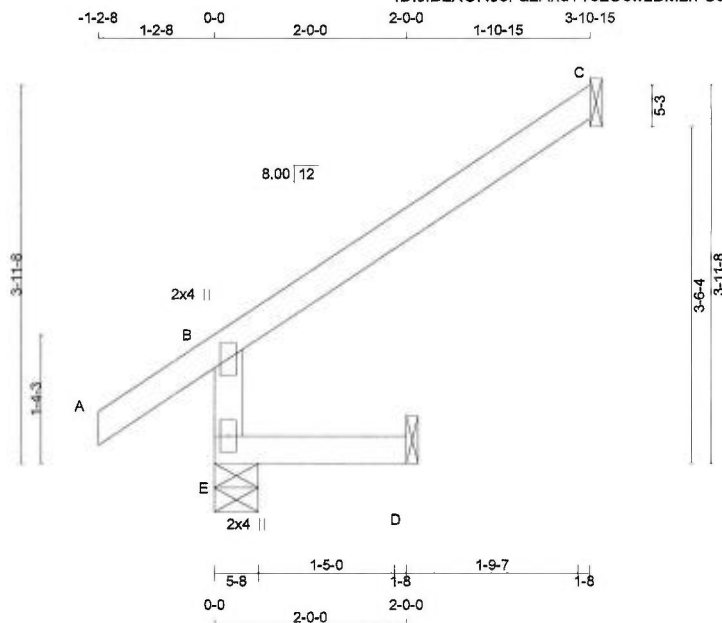

Scale = 1:23.1

TOTAL WEIGHT = 11 lb

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	SPF	SPF
E - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0	
E	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
E	309	0	309	0	5-8	5-8
C	114	0	114	0	1-8	1-8
D	16	0	16	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	
E	212	174 / 0	0 / 0	0 / 0	0 / 0	38 / 0	0 / 0
C	77	68 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0
D	13	0 / 0	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB. FR-TO	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM	TO				
E-B	-289 / 0	0.0	0.0	0.01 (4)	7.81		
A-B	0 / 28	-77.4	-77.4	0.09 (1)	10.00		
B-C	-21 / 0	-77.4	-77.4	0.20 (1)	6.25		
E-D	0 / 0	-18.2	-18.2	0.02 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.20/1.00 (B-C:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SSI=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2264 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.19 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



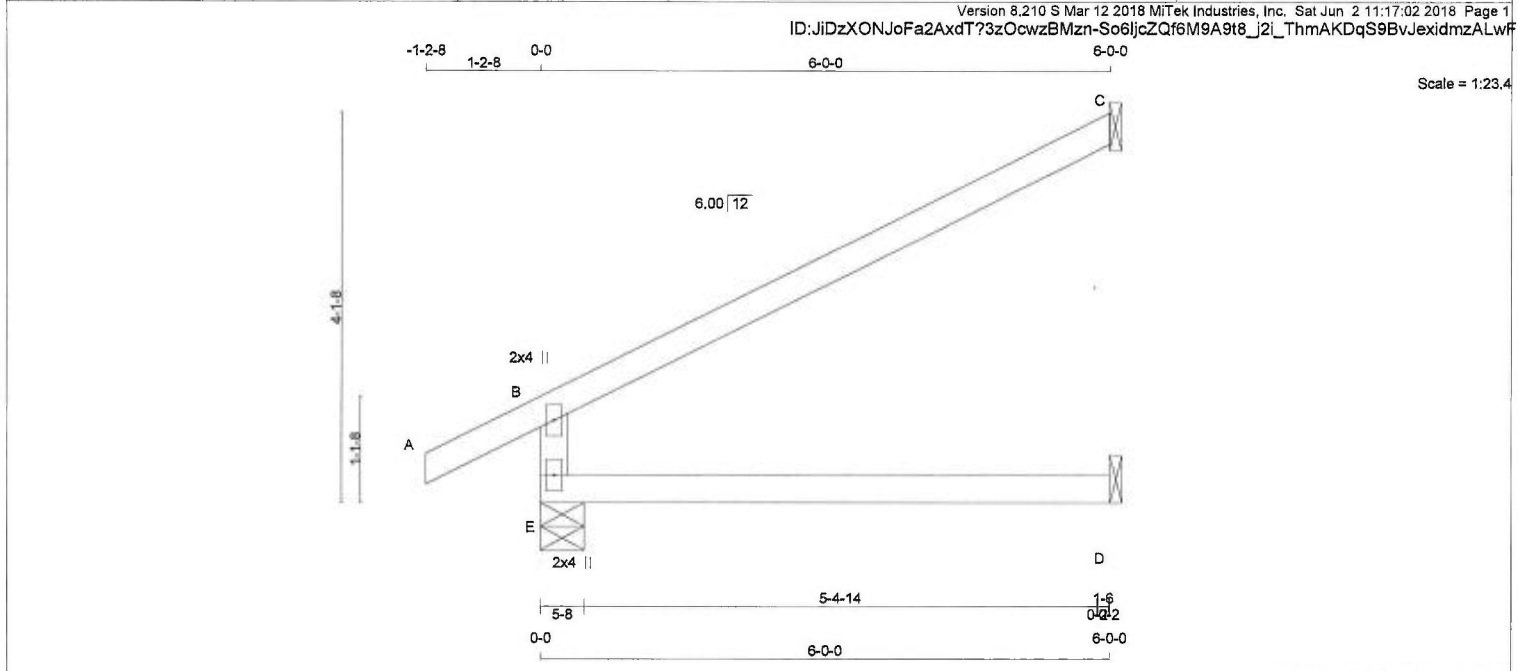

LUMBER				DESCR.	
N. L. G. A. RULES					
CHORDS	SIZE	LUMBER		SPF	
E - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	2.0	4.0	
E	BMV1+p	MT20	2.0	4.0	

READ ALL NOTES ON THIS PAGE AND ON
 ENGINEERING NOTE PAGE ENP-1. THIS
 NOTE PAGE IS AN INTEGRAL PART OF
 THIS DRAWING AS IT CONTAINS
 SPECIFICATIONS AND CRITERIA USED IN
 THE DESIGN OF THIS COMPONENT.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
E	453	0		453	0	0	5-8	5-8	
C	174	0		174	0	0	1-8	1-8	
D	45	0		50	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C , D

UNFACTORED REACTIONS							
1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	316	234 / 0	0 / 0	0 / 0	0 / 0	82 / 0	0 / 0
C	118	105 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0
D	36	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
 ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING						
TOTAL LOAD CASES: (4)						
CHORDS			WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB. MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO		FR-TO		
E- B	-389 / 0	0.0 0.0	0.11 (4)	7.81		
A- B	0 / 22	-77.4 -77.4	0.09 (1)	10.00		
B- C	-26 / 0	-77.4 -77.4	0.36 (1)	6.25		
E- D	0 / 0	-18.2 -18.2	0.14 (4)	10.00		

DESIGN CRITERIA

 SPECIFIED LOADS:
 TOP CH. LL = 23.3 PSF
 DL = 3.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.3 PSF
 TOTAL LOAD = 33.6 PSF

 SPACING = 24.0 IN./C

 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

 THIS DESIGN COMPLIES WITH:
 - PART 9 OF OBC 2012, BCBC 2012, ABC 2014
 - CSA 086-09
 - TPIC 2011

 DESIGN ASSUMPTIONS
 -OVERHANG NOT TO BE ALTERED OR CUT OFF.

 (55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

 ALLOWABLE DEFL.(LL)= L/360 (0.20")
 CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
 ALLOWABLE DEFL.(TL)= L/360 (0.20")
 CALCULATED VERT. DEFL.(TL) = L/ 999 (0.03")

 CSI: TC=0.36/1.00 (B-C:1) , BC=0.14/1.00 (D-E:4) , WB=0.00/1.00 (n/a:0) , SSI=0.20/1.00 (B-C:1)

 DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS= 1.10

 COMPANION LIVE LOAD FACTOR = 0.50

 AUTOSOLVE RIGHT HEEL ONLY

 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

 NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (Psi) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 822 2284 1656

 PLATE PLACEMENT TOL. = 0.250 inches


 PLATE ROTATION TOL. = 5.0 Deg.

 JSI GRIP= 0.22 (B) (INPUT = 0.90)
 JSI METAL= 0.09 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON
 ENGINEERING NOTE PAGE ENP-1. THIS
 NOTE PAGE IS AN INTEGRAL PART OF
 THIS DRAWING AS IT CONTAINS
 SPECIFICATIONS AND CRITERIA USED IN
 THE DESIGN OF THIS COMPONENT.



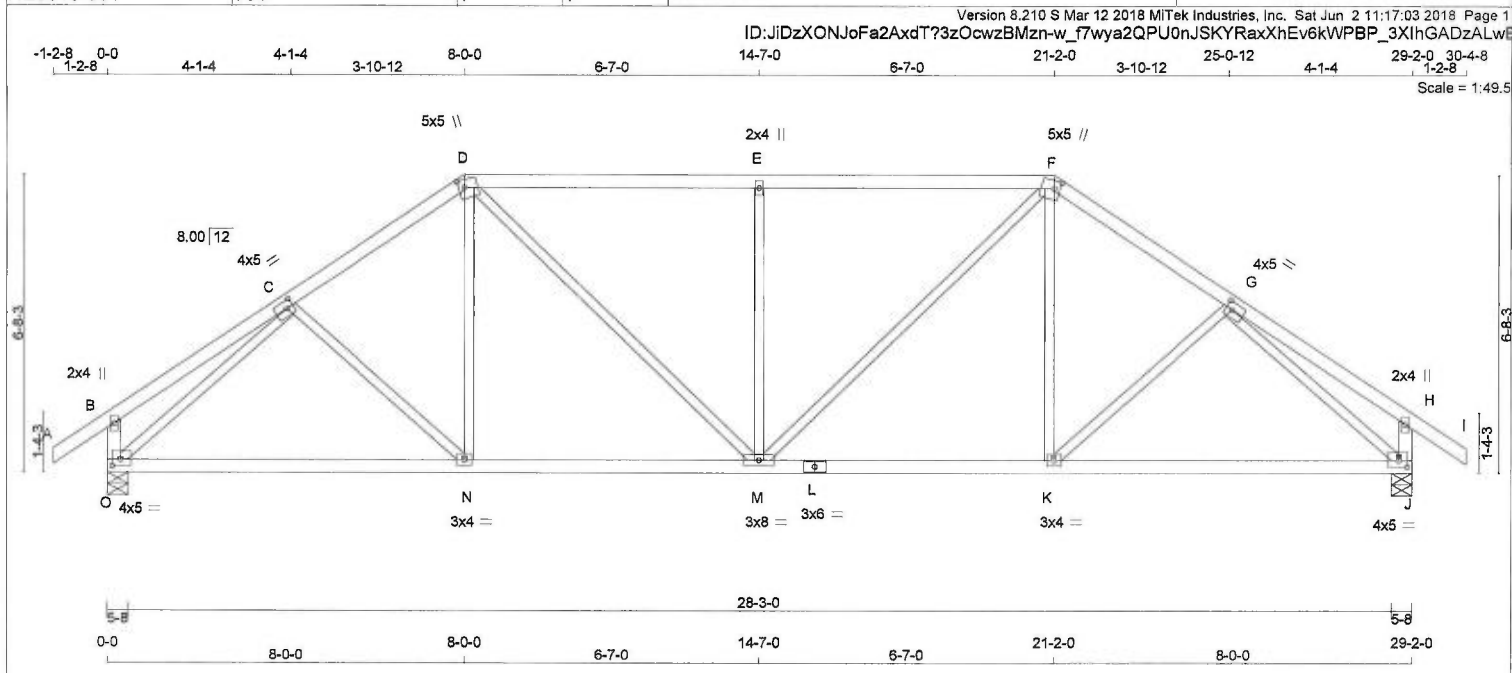

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
VERT	HORZ	DOWN	HORZ
JT O 1494 0	1494 0	0 0	5-8 5-8
J 1494 0	1494 0	0 0	5-8 5-8

UNFACTORED REACTIONS	1ST LCASE	MAX./MIN.	COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
O	1047	739 / 0	0 / 0
J	1047	739 / 0	0 / 0

ALL WEBS EXCEPT DRY: SEASONED LUMBER. BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J


BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.60 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (CSI (LC))	MAX. UNBRAC LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRAC LENGTH
FR-TO	A-B	0 / 28	-77.4	-77.4	0.09 (1)	10.00	C-N	-37 / 47	0.02 (1)
	B-C	0 / 19	-77.4	-77.4	0.19 (1)	10.00	N-D	0 / 184	0.05 (4)
	C-D	-1566 / 0	-77.4	-77.4	0.17 (1)	5.11	D-M	0 / 517	0.12 (1)
	D-E	-1659 / 0	-77.4	-77.4	0.48 (1)	4.60	M-E	-625 / 0	0.46 (1)
	E-F	-1659 / 0	-77.4	-77.4	0.48 (1)	4.60	M-F	0 / 517	0.12 (1)
	F-G	-1566 / 0	-77.4	-77.4	0.17 (1)	5.11	K-F	0 / 184	0.05 (4)
	G-H	0 / 19	-77.4	-77.4	0.19 (1)	10.00	K-G	-37 / 47	0.02 (1)
	H-I	0 / 28	-77.4	-77.4	0.09 (1)	10.00	O-C	-1788 / 0	0.86 (1)
	O-B	-221 / 0	0.0	0.0	0.02 (1)	7.81	G-J	-1788 / 0	0.86 (1)
	J-H	-221 / 0	0.0	0.0	0.02 (1)	7.81			
	O-N	0 / 1313	-18.2	-18.2	0.36 (1)	10.00			
	N-M	0 / 1288	-18.2	-18.2	0.37 (4)	10.00			
	M-L	0 / 1288	-18.2	-18.2	0.37 (4)	10.00			
	L-K	0 / 1288	-18.2	-18.2	0.37 (4)	10.00			
	K-J	0 / 1313	-18.2	-18.2	0.36 (1)	10.00			

ALLOWABLE DEFL.(LL)= L/360 (0.97")
 CALCULATED VERT. DEFL.(LL) = L/ 999 (0.07")
 ALLOWABLE DEFL.(TL)= L/360 (0.97")
 CALCULATED VERT. DEFL.(TL) = L/ 999 (0.16")
 CSI: TC=0.48/1.00 (D-E:1), BC=0.37/1.00 (M-N:4),
 WB=0.86/1.00 (C-O:1), SSI=0.25/1.00 (D-E:1)
 DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS= 1.10
 COMPANION LIVE LOAD FACTOR = 0.50
 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.
 NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 822 2284 1656
 PLATE PLACEMENT TOL. = 0.250 inches
 PLATE ROTATION TOL. = 5.0 Deg.
 JSI GRIP= 0.89 (J) (INPUT = 0.90)
 JSI METAL= 0.53 (C) (INPUT = 1.00)

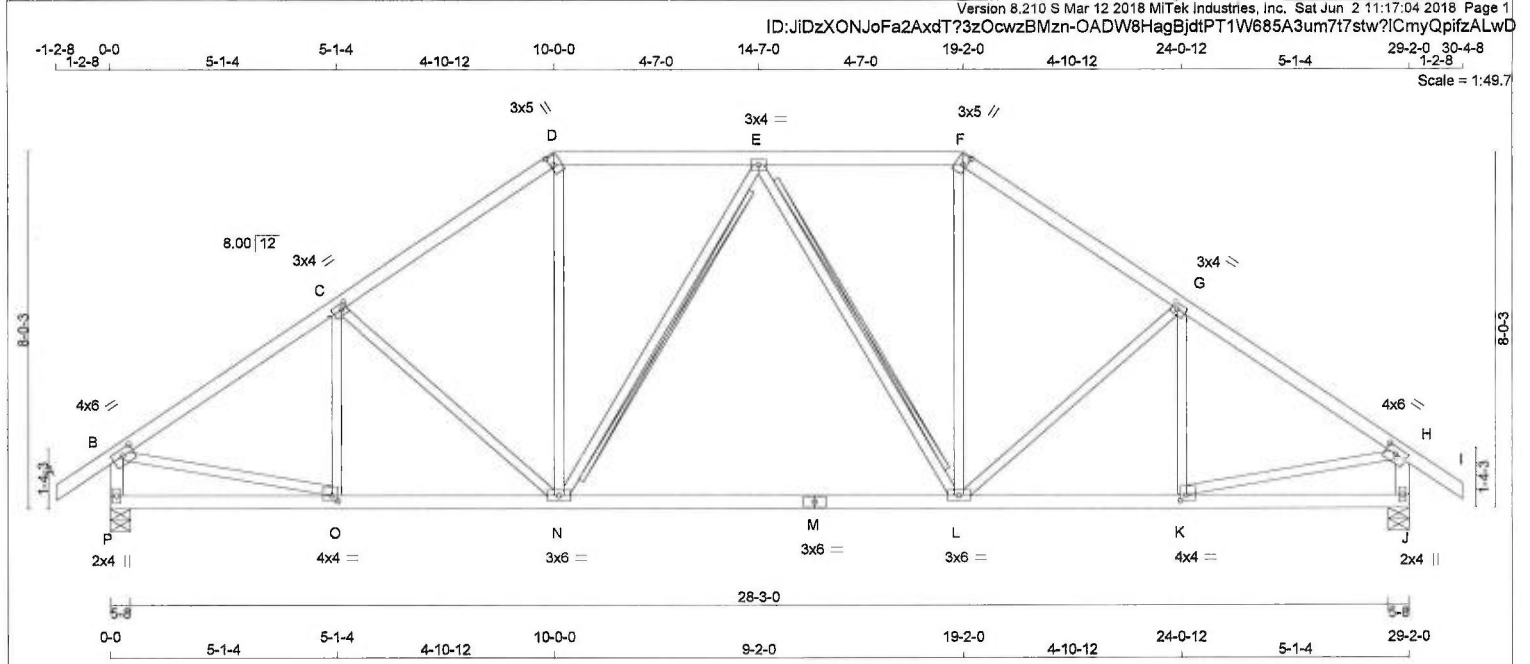

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER DESCR.

A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
P - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
P - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	6.0	1.75 3.00
C	TMVW-1	MT20	3.0	4.0	1.50 1.50
D	TTW+h	MT20	3.0	5.0	2.50 1.00
E	TMVW-1	MT20	3.0	4.0	
F	TTW+h	MT20	3.0	5.0	2.50 1.00
G	TMVW-1	MT20	3.0	4.0	1.50 1.50
H	TMVW-1	MT20	4.0	6.0	1.75 3.00
J	BMV1+p	MT20	2.0	4.0	
K	BMVW-1	MT20	4.0	4.0	1.50 1.50
L	BMVWV-1	MT20	3.0	6.0	
M	BS-1	MT20	3.0	6.0	
N	BMVWV-1	MT20	3.0	6.0	
O	BMVW-1	MT20	4.0	4.0	1.50 1.50
P	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT VERT				
P	1494 0	1494 0	5-8	5-8
J	1494 0	1494 0	5-8	5-8

UNFACTORED REACTIONS

	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
P	1047	739 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0
J	1047	739 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.91 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT E-N, E-L

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 MAX (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 28	-77.4 -77.4	0.09 (1)	10.00	O-C	-198 / 11	0.07 (1)
B-C	-1635 / 0	-77.4 -77.4	0.29 (1)	4.91	C-N	-244 / 0	0.20 (1)
C-D	-1468 / 0	-77.4 -77.4	0.27 (1)	5.13	N-D	0 / 520	0.12 (1)
D-E	-1205 / 0	-77.4 -77.4	0.22 (1)	5.59	E-L	-248 / 0	0.16 (1)
E-F	-1205 / 0	-77.4 -77.4	0.22 (1)	5.59	E-L	-248 / 0	0.16 (1)
F-G	-1468 / 0	-77.4 -77.4	0.27 (1)	5.13	L-F	0 / 520	0.12 (1)
G-H	-1635 / 0	-77.4 -77.4	0.29 (1)	4.91	L-G	-244 / 0	0.20 (1)
H-I	0 / 28	-77.4 -77.4	0.09 (1)	10.00	K-G	-198 / 11	0.07 (1)
P-B	-1451 / 0	0.0 0.0	0.15 (1)	6.79	B-O	0 / 1408	0.32 (1)
J-H	-1451 / 0	0.0 0.0	0.15 (1)	6.79	K-H	0 / 1408	0.32 (1)
P-O	0 / 0	-18.2 -18.2	0.11 (4)	10.00			
O-N	0 / 1381	-18.2 -18.2	0.36 (1)	10.00			
N-M	0 / 1330	-18.2 -18.2	0.35 (1)	10.00			
M-L	0 / 1330	-18.2 -18.2	0.35 (1)	10.00			
L-K	0 / 1381	-18.2 -18.2	0.36 (1)	10.00			
K-J	0 / 0	-18.2 -18.2	0.11 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.06")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.20")

CSI: TC=0.29/1.00 (B-C:1), BC=0.36/1.00 (N-O:1), WB=0.32/1.00 (B-O:1), SSI=0.17/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (N) (INPUT = 0.90)
JSI METAL= 0.52 (O) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



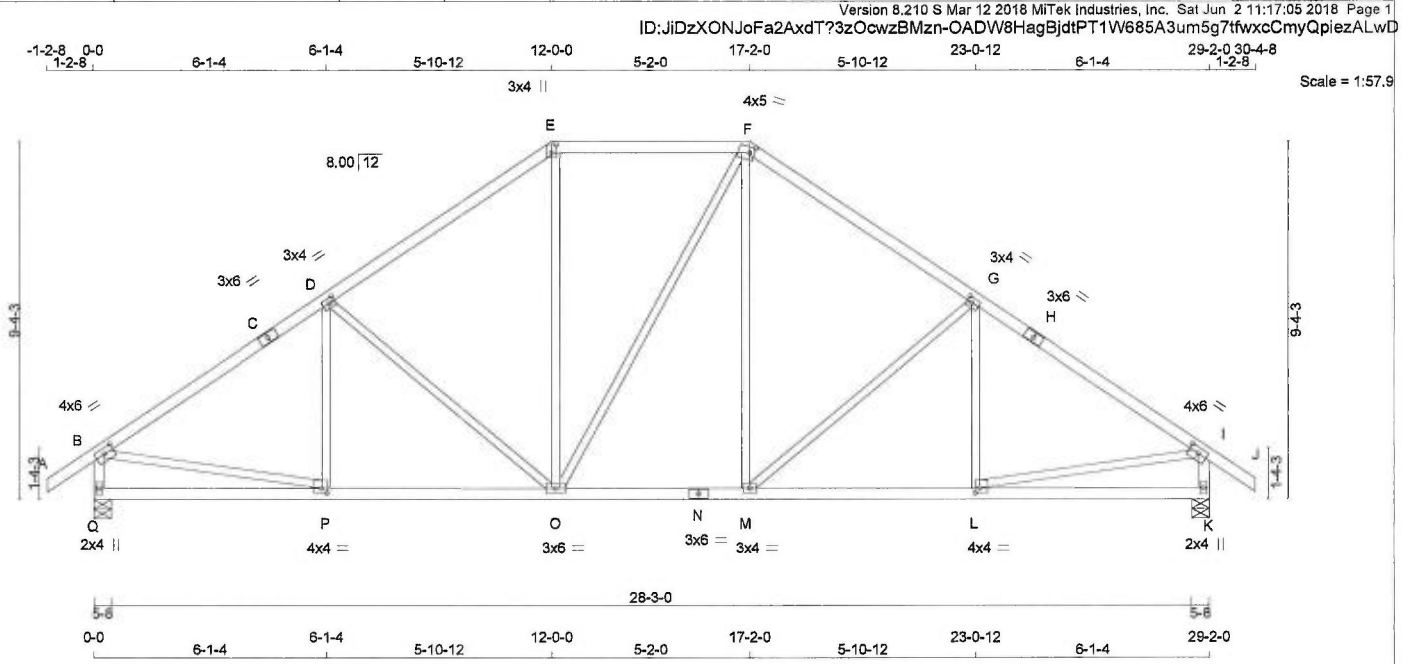

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER DESCR.

A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - J	2x4	DRY	No.2	SPF
Q - B	2x4	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF
Q - N	2x4	DRY	No.2	SPF
N - K	2x4	DRY	No.2	SPF

ALL WEBS EXCEPT 2x3 DRY, SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-I	MT20	4.0	6.0	1.75	3.00
C	TS-I	MT20	3.0	6.0		
D	TMVW-I	MT20	3.0	4.0	1.50	1.50
E	TTW+p	MT20	3.0	4.0	2.50	1.50
F	TTW+m	MT20	4.0	5.0	1.75	1.50
G	TMVW-I	MT20	3.0	4.0	1.50	1.50
H	TS-I	MT20	3.0	6.0		
I	TMVW-I	MT20	4.0	6.0	1.75	3.00
K	BMV1+p	MT20	2.0	4.0		
L	BMVW-I	MT20	4.0	4.0	1.50	1.50
M	BMVW-I	MT20	3.0	4.0		
N	BS-I	MT20	3.0	6.0		
O	BMVW-I	MT20	3.0	6.0		
P	BMVW-I	MT20	4.0	4.0	1.50	1.50
Q	BMV1+p	MT20	2.0	4.0		



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
Q	1494	0	1494	0	5-8	5-8
K	1494	0	1494	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
Q	1047	739 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0
K	1047	739 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	MEMB.
FR-TO				FR-TO			
A-B	0 / 28	-77.4	-77.4 0.09 (1)	10.00	P-D	-113 / 71	0.05 (1)
B-C	-1649 / 0	-77.4	-77.4 0.43 (1)	4.72	D-O	-403 / 0	0.52 (1)
C-D	-1649 / 0	-77.4	-77.4 0.43 (1)	4.72	O-E	0 / 359	0.08 (1)
D-E	-1344 / 0	-77.4	-77.4 0.39 (1)	5.15	E-F	0 / 1	0.00 (1)
E-F	-1094 / 0	-77.4	-77.4 0.28 (1)	5.71	F-G	0 / 357	0.08 (1)
F-G	-1343 / 0	-77.4	-77.4 0.39 (1)	5.15	G-H	-404 / 0	0.52 (1)
G-H	-1650 / 0	-77.4	-77.4 0.43 (1)	4.72	H-I	-112 / 71	0.05 (1)
H-I	-1650 / 0	-77.4	-77.4 0.43 (1)	4.72	I-J	0 / 1417	0.32 (1)
I-J	0 / 28	-77.4	-77.4 0.09 (1)	10.00	J-K	0 / 1418	0.32 (1)
Q-B	-1448 / 0	0.0	0.0 0.15 (1)	6.79			
K-I	-1448 / 0	0.0	0.0 0.15 (1)	6.79			
Q-P	0 / 0	-18.2	-18.2 0.16 (4)	10.00			
P-O	0 / 1398	-18.2	-18.2 0.30 (1)	10.00			
O-N	0 / 1094	-18.2	-18.2 0.24 (1)	10.00			
N-M	0 / 1094	-18.2	-18.2 0.24 (1)	10.00			
M-L	0 / 1398	-18.2	-18.2 0.31 (1)	10.00			
L-K	0 / 0	-18.2	-18.2 0.16 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CSI: TC=0.43/1.00 (G-I:1), BC=0.31/1.00 (L-M:1), WB=0.52/1.00 (G-M:1), SI=0.19/1.00 (B-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES						
PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (O) (INPUT = 0.90)
JSI METAL= 0.52 (L) (INPUT = 1.00)



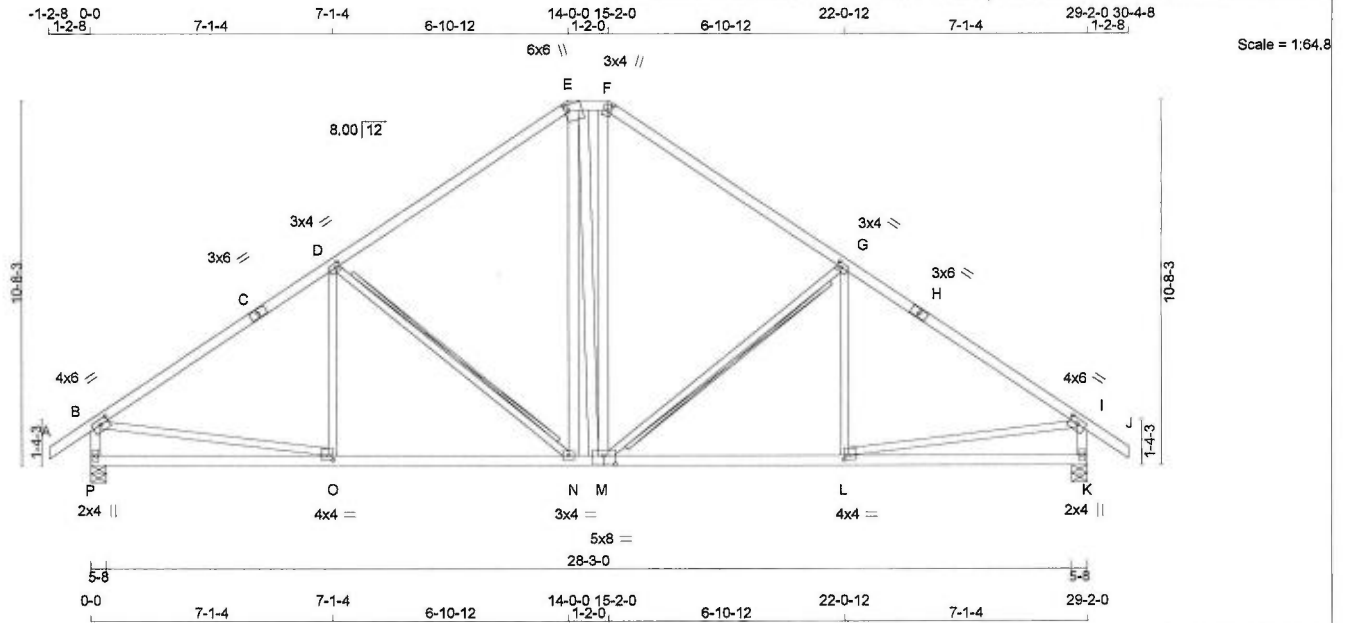

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N. L. G. A. RULES				
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - J	2x4	DRY	No.2	SPF
J - B	2x4	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF
P - M	2x4	DRY	No.2	SPF
M - K	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
N - E	2x4	DRY	No.2	SPF
E - M	2x4	DRY	No.2	SPF
M - F	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	6.0	1.75	3.00
C	TS-t	MT20	3.0	6.0		
D	TMVW-t	MT20	3.0	4.0	1.50	1.50
E	TTW+m	MT20	6.0	6.0	2.00	1.25
F	TTW+m	MT20	3.0	4.0	2.00	1.25
G	TMVW-t	MT20	3.0	4.0	1.50	1.50
H	TS-t	MT20	3.0	6.0		
I	TMVW-t	MT20	4.0	6.0	1.75	3.00
K	BMV1+p	MT20	2.0	4.0		
L	BMVW-t	MT20	4.0	4.0	1.50	1.50
M	BSVW-t	MT20	5.0	8.0	3.00	4.00
N	BMVW-t	MT20	3.0	4.0		
O	BMVW-t	MT20	4.0	4.0	1.50	1.50
P	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
P	1494	0	1494	0	5-8	5-8
K	1494	0	1494	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
P	1047	739 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0
K	1047	739 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.48 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT D-N, G-M

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)		
FR-TO		FROM	TO		FR-TO				
A-B	0 / 28	-77.4	-77.4	0.09 (1)	10.00	O-D	-54 / 107	0.04 (4)	
B-C	-1641 / 0	-77.4	-77.4	0.61 (1)	4.48	D-N	-541 / 0	0.35 (1)	
C-D	-1641 / 0	-77.4	-77.4	0.61 (1)	4.48	N-E	0 / 372	0.06 (1)	
D-E	-1213 / 0	-77.4	-77.4	0.55 (1)	5.10	E-M	0 / 37	0.01 (1)	
E-F	-986 / 0	-77.4	-77.4	0.02 (1)	6.25	M-F	0 / 409	0.07 (1)	
F-G	-1213 / 0	-77.4	-77.4	0.55 (1)	5.10	M-G	-538 / 0	0.35 (1)	
G-H	-1640 / 0	-77.4	-77.4	0.61 (1)	4.48	L-G	-59 / 105	0.04 (4)	
H-I	-1640 / 0	-77.4	-77.4	0.61 (1)	4.48	B-O	0 / 1410	0.32 (1)	
I-J	0 / 28	-77.4	-77.4	0.09 (1)	10.00	L-I	0 / 1409	0.32 (1)	
P-B	-1442 / 0	0.0	0.0	0.15 (1)	6.81				
K-I	-1441 / 0	0.0	0.0	0.15 (1)	6.81				
P-O	0 / 0	-18.2	-18.2	0.23 (4)	10.00				
O-N	0 / 1396	-18.2	-18.2	0.35 (1)	10.00				
N-M	0 / 982	-18.2	-18.2	0.26 (1)	10.00				
M-L	0 / 1395	-18.2	-18.2	0.34 (1)	10.00				
L-K	0 / 0	-18.2	-18.2	0.22 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	23.3	PSF
DL	=	3.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.3	PSF
TOTAL LOAD	=	33.6	PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.61/1.00 (B-D:1), BC=0.35/1.00 (N-O:1), WB=0.35/1.00 (D-N:1), SSI=0.22/1.00 (B-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354
	1667	822
	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.87 (F) (INPUT = 0.90)

JSI METAL= 0.52 (O) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



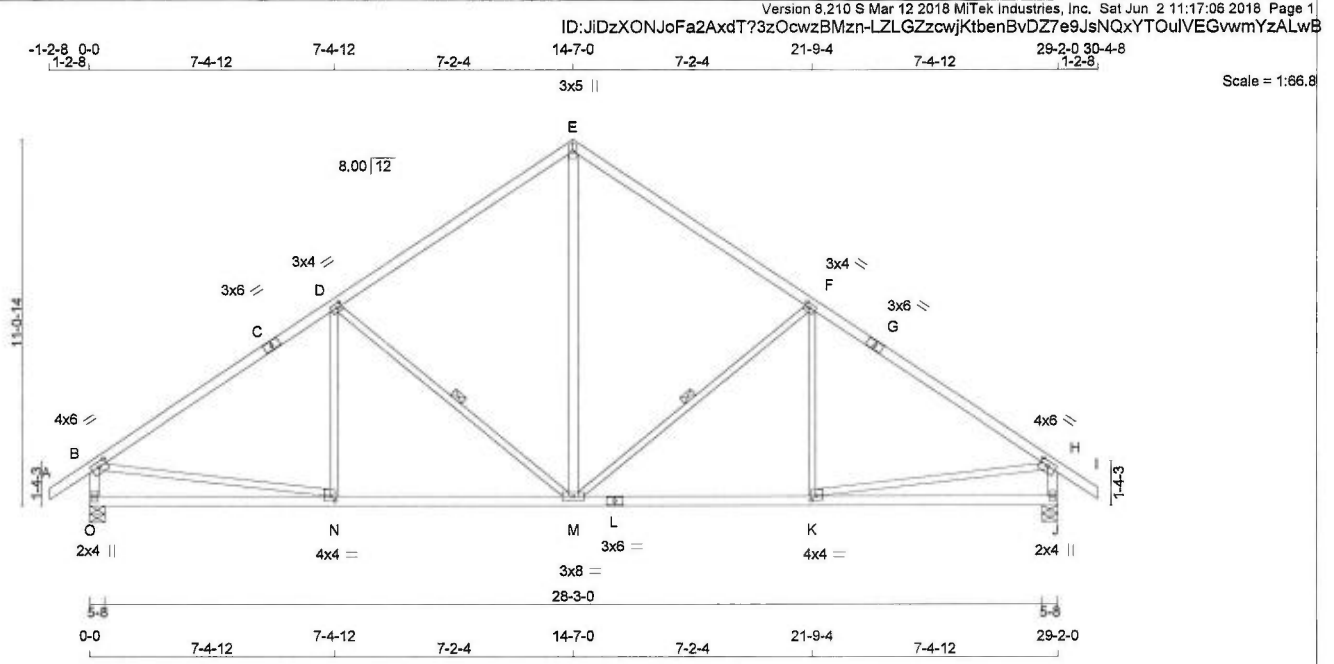

LUMBER										DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										DESIGN CRITERIA									
N. L. G. A. RULES										BEARINGS										SPECIFIED LOADS:									
CHORDS SIZE LUMBER DESCR.																				TOP CH. LL = 23.3 PSF									
																				DL = 3.0 PSF									
A - C 2x4 DRY No.2 SPF										FACTORED MAXIMUM FACTORED INPUT REQRD										BOT CH. LL = 0.0 PSF									
C - E 2x4 DRY No.2 SPF										GROSS REACTION GROSS REACTION BRG BRG										DL = 7.3 PSF									
E - G 2x4 DRY No.2 SPF										JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX										TOTAL LOAD = 33.6 PSF									
G - I 2x4 DRY No.2 SPF										O 1494 0 1494 0 0 5-8 5-8																			
O - B 2x4 DRY No.2 SPF										J 1494 0 1494 0 0 5-8 5-8																			
J - H 2x4 DRY No.2 SPF																													
O - L 2x4 DRY No.2 SPF																													
L - J 2x4 DRY No.2 SPF																													
										UNFACTORED REACTIONS																			
										1ST LCASE MAX./MIN. COMPONENT REACTIONS																			
ALL WEBS 2x3 DRY No.2 SPF										JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL										THIS TRUSS IS DESIGNED FOR RESIDENTIAL									
EXCEPT										O 1047 739 / 0 0 / 0 0 / 0 308 / 0 0 / 0										OR SMALL BUILDING REQUIREMENTS OF									
M - E 2x4 DRY No.2 SPF										J 1047 739 / 0 0 / 0 0 / 0 308 / 0 0 / 0										PART 9, NBCC 2010									


DRY: SEASONED LUMBER.

PLATES (table is in inches)						UNFACTORED REACTIONS					
JT	TYPE	PLATES	W	LEN	Y	X	1ST LCASE	MAX./MIN.	COMPONENT	REACTIONS	
B	TMVW-I	MT20	4.0	6.0	1.75	3.00	JT	COMBINED	SNOW	LIVE	PERM.LIVE
C	TS-I	MT20	3.0	6.0			O	1047	739 / 0	0 / 0	0 / 0
D	TMVW-I	MT20	3.0	4.0	1.50	1.50	J	1047	739 / 0	0 / 0	0 / 0
E	TTW+p	MT20	3.0	5.0							
F	TMVW-I	MT20	3.0	4.0	1.50	1.50					
G	TS-I	MT20	3.0	6.0							
H	TMVW-I	MT20	4.0	6.0	1.75	3.00					
J	BMV1+p	MT20	2.0	4.0							
K	BMVW-I	MT20	4.0	4.0	1.50	1.50					
L	BS-I	MT20	3.0	6.0							
M	BMVW-I	MT20	3.0	8.0							
N	BMVW-I	MT20	4.0	4.0	1.50	1.50					
O	BMV1+p	MT20	2.0	4.0							

	CHORDS					WEBS				
	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (CSI (LC))	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)		
	FR-TO		FROM	TO		FR-TO				
	A-B	0 / 28	-77.4	-77.4	0.09 (1)	10.00	M-E	0 / 853	0.14 (1)	
	B-C	-1635 / 0	-77.4	-77.4	0.67 (1)	4.39	M-F	-571 / 0	0.35 (1)	
	C-D	-1635 / 0	-77.4	-77.4	0.67 (1)	4.39	K-F	-45 / 112	0.04 (4)	
	D-E	-1183 / 0	-77.4	-77.4	0.60 (1)	5.05	D-M	-571 / 0	0.35 (1)	
	E-F	-1183 / 0	-77.4	-77.4	0.60 (1)	5.05	N-D	-45 / 112	0.04 (4)	
	F-G	-1635 / 0	-77.4	-77.4	0.67 (1)	4.39	B-N	0 / 1405	0.32 (1)	
	G-H	-1635 / 0	-77.4	-77.4	0.67 (1)	4.39	K-H	0 / 1405	0.32 (1)	
	H-I	0 / 28	-77.4	-77.4	0.09 (1)	10.00				
	O-B	-1439 / 0	0.0	0.0	0.15 (1)	6.81				
	J-H	-1439 / 0	0.0	0.0	0.15 (1)	6.81				
	O-N	0 / 0	-18.2	-18.2	0.24 (4)	10.00				
	N-M	0 / 1392	-18.2	-18.2	0.35 (1)	10.00				
	M-L	0 / 1392	-18.2	-18.2	0.35 (1)	10.00				
	L-K	0 / 1392	-18.2	-18.2	0.35 (1)	10.00				
	K-J	0 / 0	-18.2	-18.2	0.24 (4)	10.00				

COMPANION LIVE LOAD FACTOR = 0.50			
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.			
NAIL VALUES			
PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	SECTION (PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656
PLATE PLACEMENT TOL. = 0.250 inches			
PLATE ROTATION TOL. = 5.0 Deg.			
JSI GRIP= 0.85 (M) (INPUT = 0.90)			
JSI METAL= 0.52 (N) (INPUT = 1.00)			

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

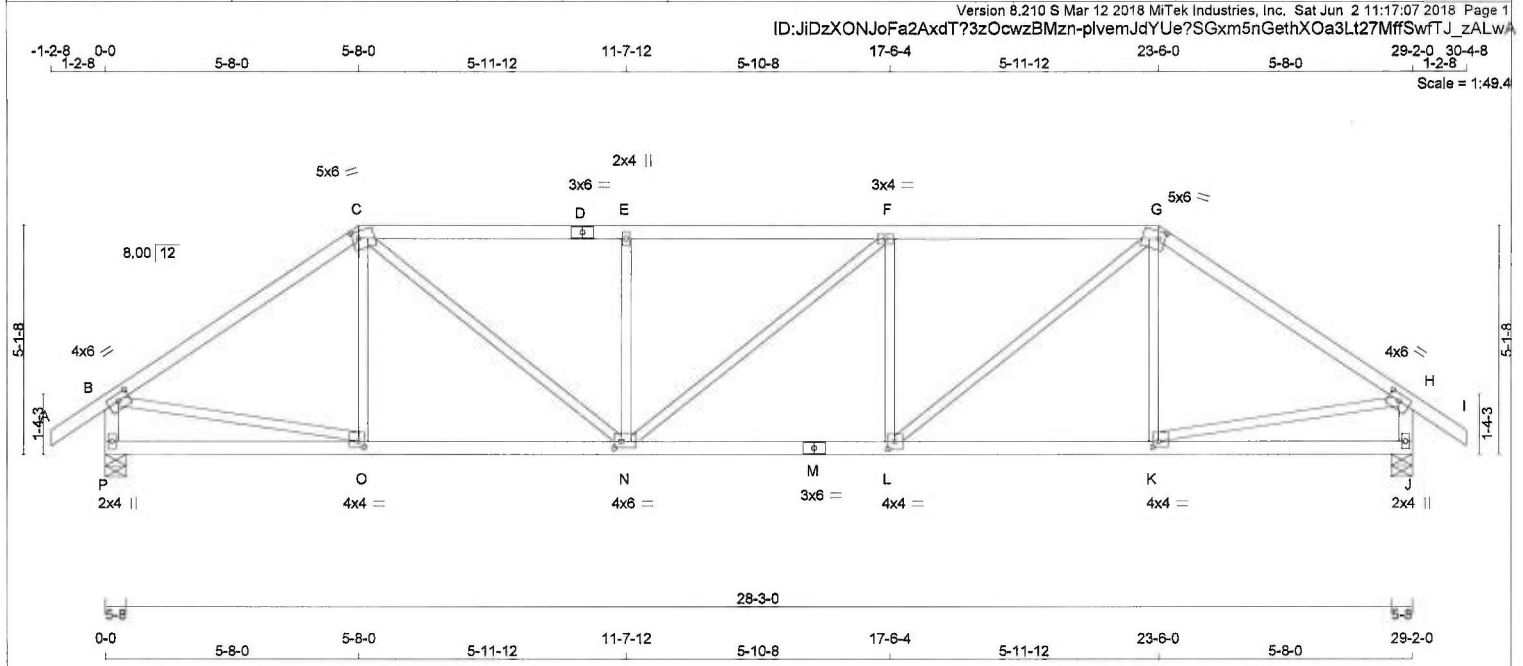

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - D	2x4	DRY No.2	SPF
D - G	2x4	DRY No.2	SPF
G - I	2x4	DRY No.2	SPF
P - B	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
P - M	2x4	DRY No.2	SPF
M - J	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	6.0	1.75	3.00
C	TTWW-m	MT20	5.0	6.0	2.00	1.75
D	TS-t	MT20	3.0	6.0		
E	TMW+w	MT20	2.0	4.0		
F	TMWW-t	MT20	3.0	4.0		
G	TTWW-m	MT20	5.0	6.0	2.00	1.75
H	TMVW-t	MT20	4.0	6.0	1.75	3.00
J	BMV1+p	MT20	2.0	4.0		
K	BMWW-t	MT20	4.0	4.0	1.50	1.50
L	BMWW-t	MT20	4.0	4.0	2.00	1.75
M	BS-t	MT20	3.0	6.0		
N	BMWWW-t	MT20	4.0	6.0	1.75	2.00
O	BMWW-t	MT20	4.0	4.0	1.50	1.50
P	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
P	1494	0	1494	0
J	1494	0	1494	0

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
P	1047	739 / 0	0 / 0	0 / 0	0 / 0
J	1047	739 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.21 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LC1 MAX (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 28	-77.4	-77.4 0.09 (1)	10.00	C-C	-118 / 61	0.05 (1)
B-C	-1609 / 0	-77.4	-77.4 0.55 (1)	4.58	C-N	0 / 955	0.22 (1)
C-D	-2079 / 0	-77.4	-77.4 0.48 (1)	4.22	N-E	-495 / 0	0.19 (1)
D-E	-2079 / 0	-77.4	-77.4 0.48 (1)	4.22	E-F	-2 / 0	0.00 (1)
E-F	-2079 / 0	-77.4	-77.4 0.49 (1)	4.21	F-G	-497 / 0	0.19 (1)
F-G	-2080 / 0	-77.4	-77.4 0.49 (1)	4.21	G-H	0 / 958	0.22 (1)
G-H	-1609 / 0	-77.4	-77.4 0.55 (1)	4.58	H-I	-118 / 61	0.05 (1)
H-I	0 / 28	-77.4	-77.4 0.09 (1)	10.00	I-J	0 / 1358	0.31 (1)
I-J	-1452 / 0	0.0	0.0 0.15 (1)	6.79	J-K	0 / 1358	0.31 (1)
J-K	-1452 / 0	0.0	0.0 0.15 (1)	6.79			
P-O	0 / 0	-18.2	-18.2 0.15 (4)	10.00			
O-N	0 / 1335	-18.2	-18.2 0.30 (1)	10.00			
N-M	0 / 2080	-18.2	-18.2 0.39 (1)	10.00			
M-L	0 / 2080	-18.2	-18.2 0.39 (1)	10.00			
L-K	0 / 1334	-18.2	-18.2 0.30 (1)	10.00			
K-J	0 / 0	-18.2	-18.2 0.15 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.19")

CSI: TC=0.55/1.00 (B-C:1), BC=0.39/1.00 (L-N:1), WB=0.31/1.00 (B-O:1), SSI=0.21/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (G) (INPUT = 0.90)
JSI METAL= 0.57 (M) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



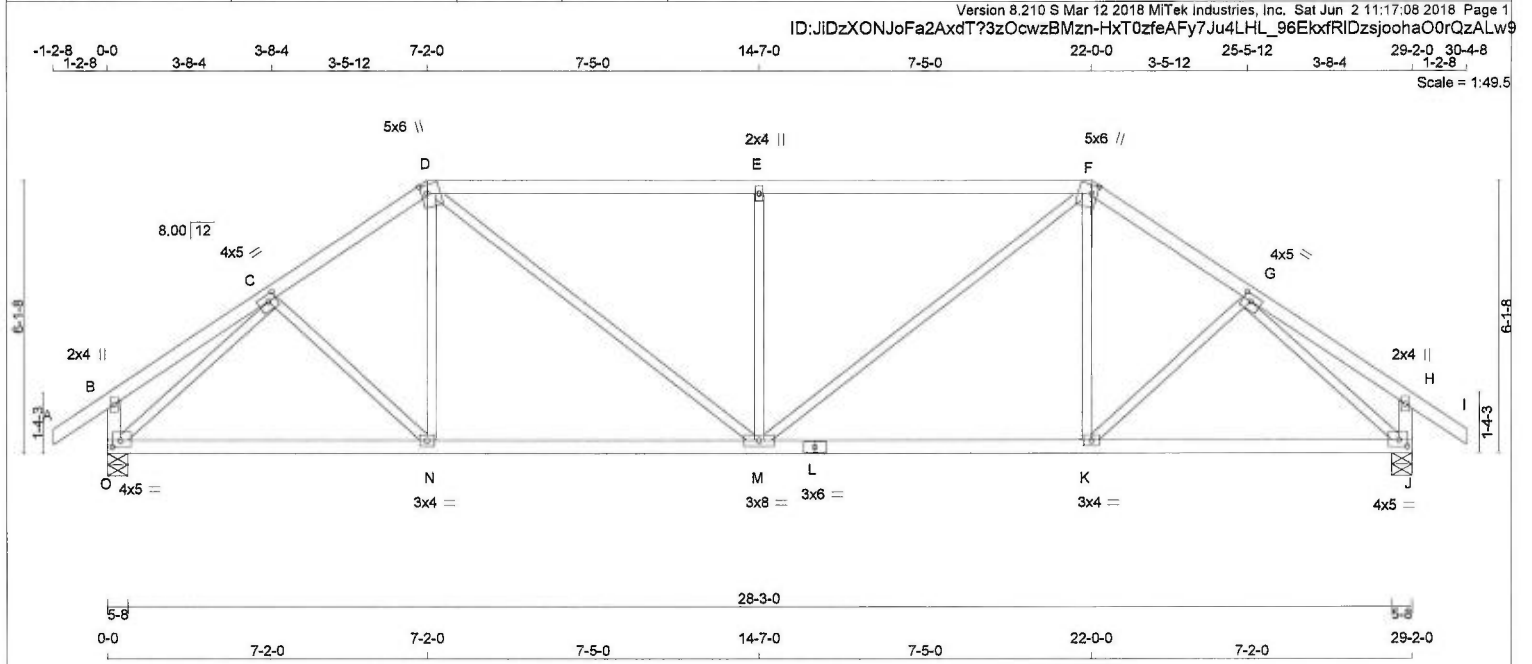

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
O - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
O - L	2x4	DRY	No.2
L - J	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
C	TMWW-t	MT20	4.0	5.0	1.75	2.25
D	TTWW+m	MT20	5.0	6.0	2.25	1.50
E	TMW+w	MT20	2.0	4.0		
F	TTWW+m	MT20	5.0	6.0	2.25	1.50
G	TMWW-t	MT20	4.0	5.0	1.75	2.25
H	TMV+p	MT20	2.0	4.0		
J	BMVW1-t	MT20	4.0	5.0	1.75	2.25
K	BMWW-t	MT20	3.0	4.0		
L	BS-t	MT20	3.0	6.0		
M	BMWWH-t	MT20	3.0	8.0		
N	BMWW-t	MT20	3.0	4.0		
O	BMVW1-t	MT20	4.0	5.0	1.75	2.25

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
O	1494	0	1494	0	5-8	5-8
J	1494	0	1494	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE		
O	1047	739 / 0	0 / 0	0 / 0	308 / 0	0 / 0
J	1047	739 / 0	0 / 0	0 / 0	308 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.60 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		MAX. UNBRAC LENGTH	MEMB.	WEBS	
	FORCE (LBS)	VERT. LOAD (PLF)	TO	FROM			FORCE (LBS)	MAX. FACTORED (LC)
A-B	0 / 28	-77.4	-77.4	0.09 (1)	10.00	C-N	0 / 59	0.02 (4)
B-C	0 / 16	-77.4	-77.4	0.14 (1)	10.00	N-D	0 / 133	0.04 (4)
C-D	-1594 / 0	-77.4	-77.4	0.18 (1)	5.06	D-M	0 / 672	0.15 (1)
D-E	-1841 / 0	-77.4	-77.4	0.95 (1)	3.60	M-E	-706 / 0	0.42 (1)
E-F	-1841 / 0	-77.4	-77.4	0.95 (1)	3.60	M-F	0 / 672	0.15 (1)
F-G	-1594 / 0	-77.4	-77.4	0.18 (1)	5.06	K-F	0 / 133	0.04 (4)
G-H	0 / 16	-77.4	-77.4	0.14 (1)	10.00	K-G	0 / 59	0.02 (4)
H-I	0 / 28	-77.4	-77.4	0.09 (1)	10.00	O-C	-1784 / 0	0.70 (1)
O-B	-209 / 0	0.0	0.0	0.02 (1)	7.81	G-J	-1784 / 0	0.70 (1)
J-H	-209 / 0	0.0	0.0	0.02 (1)	7.81			
O-N	0 / 1291	-18.2	-18.2	0.34 (1)	10.00			
N-M	0 / 1313	-18.2	-18.2	0.35 (1)	10.00			
M-L	0 / 1313	-18.2	-18.2	0.35 (1)	10.00			
L-K	0 / 1313	-18.2	-18.2	0.35 (1)	10.00			
K-J	0 / 1291	-18.2	-18.2	0.34 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.15")

CSI: TC=0.95/1.00 (E-F:1), BC=0.35/1.00 (M-N:1), WB=0.70/1.00 (C-O:1), SSI=0.28/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (C) (INPUT = 0.90)
JSI METAL= 0.53 (G) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



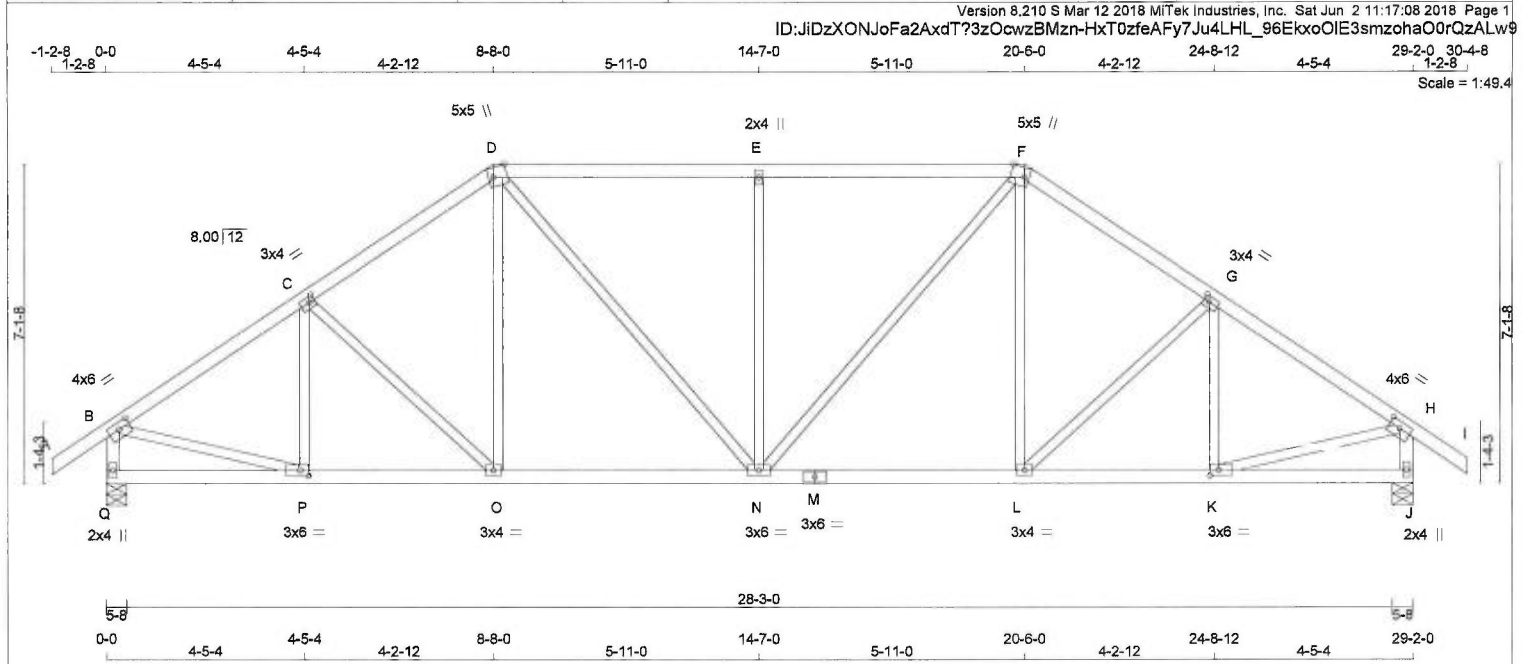

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER DESCR.

A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
Q - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
Q - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-H	MT20	4.0	6.0	1.75 3.00
C	TMVW-H	MT20	3.0	4.0	1.50 1.50
D	TTWV-H	MT20	5.0	5.0	Edge 3.75
E	TMVW-H	MT20	2.0	4.0	
F	TTWV-H	MT20	5.0	5.0	Edge 3.75
G	TMVW-H	MT20	3.0	4.0	1.50 1.50
H	TMVW-H	MT20	4.0	6.0	1.75 3.00
J	BMV-H	MT20	2.0	4.0	
K	BMV-H	MT20	3.0	6.0	1.50 2.25
L	BMV-H	MT20	3.0	4.0	
M	BS-H	MT20	3.0	6.0	
N	BMVW-H	MT20	3.0	6.0	
O	BMVW-H	MT20	3.0	4.0	
P	BMVW-H	MT20	3.0	6.0	1.50 2.25
Q	BMV-H	MT20	2.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT VERT	1494	1494	0	5-8
Q	1494	1494	0	5-8
J	1494	1494	0	5-8

UNFACTORED REACTIONS

	1ST LCASE	MAX./MIN.	COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
Q	1047	739 / 0	0 / 0
J	1047	739 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.88 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	MAX. FACTORED FORCE (LBS)
FR-TO		FROM	TO	FR-TO			
A-B	0 / 28	-77.4	-77.4 0.09 (1)	10.00	P-C	-237 / 0	0.07 (1)
B-C	-1616 / 0	-77.4	-77.4 0.21 (1)	5.01	C-D	-154 / 0	0.09 (1)
C-D	-1526 / 0	-77.4	-77.4 0.21 (1)	5.13	D-E	0 / 201	0.05 (1)
D-E	-1542 / 0	-77.4	-77.4 0.38 (1)	4.88	E-F	0 / 443	0.10 (1)
E-F	-1526 / 0	-77.4	-77.4 0.21 (1)	5.13	F-G	-560 / 0	0.49 (1)
F-G	-1526 / 0	-77.4	-77.4 0.21 (1)	5.01	G-H	0 / 201	0.05 (1)
G-H	-1616 / 0	-77.4	-77.4 0.21 (1)	5.01	H-I	-154 / 0	0.09 (1)
H-I	0 / 28	-77.4	-77.4 0.09 (1)	10.00	I-J	-237 / 0	0.07 (1)
I-J	-1458 / 0	0.0	0.0 0.15 (1)	6.77	J-K	0 / 1398	0.31 (1)
J-K	-1458 / 0	0.0	0.0 0.15 (1)	6.77	K-L	0 / 1398	0.31 (1)
K-L	0 / 0	-18.2	-18.2 0.07 (4)	10.00	L-M	0 / 1362	-18.2 0.28 (1)
L-M	0 / 1362	-18.2	-18.2 0.28 (1)	10.00	M-N	0 / 1252	-18.2 0.27 (1)
M-N	0 / 1252	-18.2	-18.2 0.27 (1)	10.00	N-O	0 / 1252	-18.2 0.27 (1)
N-O	0 / 1252	-18.2	-18.2 0.27 (1)	10.00	O-P	0 / 1252	-18.2 0.27 (1)
O-P	0 / 1252	-18.2	-18.2 0.27 (1)	10.00	P-Q	0 / 1362	-18.2 0.28 (1)
P-Q	0 / 1362	-18.2	-18.2 0.28 (1)	10.00	Q-R	0 / 0	-18.2 0.07 (4)
Q-R	0 / 0	-18.2	-18.2 0.07 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.38/1.00 (D-E:1), BC=0.28/1.00 (O-P:1), WB=0.49/1.00 (E-N:1), SS=0.22/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (N) (INPUT = 0.90)
JSI METAL= 0.44 (B) (INPUT = 1.00)



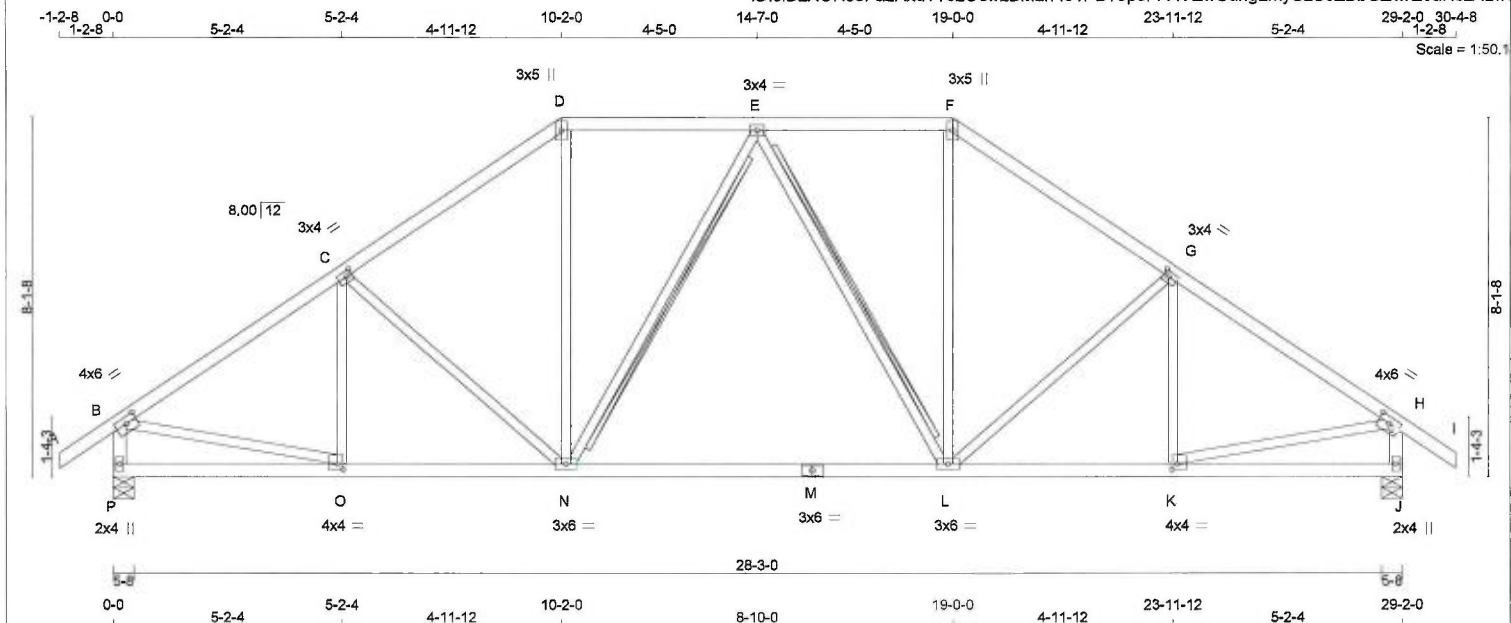

TOTAL WEIGHT = 129 lb
[M][F]

N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
P - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
P - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

J	T	PLATES	W	L	E	N	X	X
B	TMWV-t	MT20	4.0	6.0	1.75	3.00		
C	TMWV-t	MT20	3.0	4.0	1.50	1.50		
D	TTW+p	MT20	3.0	5.0				
E	TMWV-t	MT20	3.0	4.0				
F	TTW+p	MT20	3.0	5.0				
G	TMWV-t	MT20	3.0	4.0	1.50	1.50		
H	TMWV-t	MT20	4.0	6.0	1.75	3.00		
I	BMV1+p	MT20	2.0	4.0				
K	BMWV-t	MT20	4.0	4.0	1.50	1.50		
L	BMWVW-t	MT20	3.0	6.0				
M	BS-t	MT20	3.0	6.0				
N	BMWVW-t	MT20	3.0	6.0				
O	BMWV-t	MT20	4.0	4.0	1.50	1.50		
P	BMV1+p	MT20	2.0	4.0				

	FACTORED		MAXIMUM FACTORED			INPUT	REQRD
	GROSS REACTION		GROSS REACTION			BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
P	1494	0	1494	0	0	5-8	5-8
J	1494	0	1494	0	0	5-8	5-8

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
P	1047	739 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0
J	1047	739 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.89 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT E-N, E-L

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM TO		LENGTH	FR-TO			
A-B	0 / 28	-77.4	-77.4	0.09 (1)	10.00	O-C	-189 / 17	0.06 (1)
B-C	-1637 / 0	-77.4	-77.4	0.30 (1)	4.89	N-D	-258 / 0	0.22 (1)
C-D	-1458 / 0	-77.4	-77.4	0.28 (1)	5.13	C-N	0 / 516	0.12 (1)
D-E	-1196 / 0	-77.4	-77.4	0.20 (1)	5.63	N-E	-236 / 0	0.15 (1)
E-F	-1196 / 0	-77.4	-77.4	0.20 (1)	5.63	E-L	-236 / 0	0.15 (1)
F-G	-1458 / 0	-77.4	-77.4	0.28 (1)	5.13	L-F	0 / 516	0.12 (1)
G-H	-1637 / 0	-77.4	-77.4	0.30 (1)	4.89	L-G	-258 / 0	0.22 (1)
H-I	0 / 28	-77.4	-77.4	0.09 (1)	10.00	K-G	-189 / 17	0.06 (1)
P-B	-1451 / 0	0.0	0.0	0.15 (1)	6.79	B-O	0 / 1410	0.32 (1)
J-H	-1451 / 0	0.0	0.0	0.15 (1)	6.79	K-H	0 / 1410	0.32 (1)
P-O	0 / 0	-18.2	-18.2	0.11 (4)	10.00			
O-N	0 / 1383	-18.2	-18.2	0.35 (1)	10.00			
N-M	0 / 1310	-18.2	-18.2	0.33 (1)	10.00			
M-L	0 / 1310	-18.2	-18.2	0.33 (1)	10.00			
L-K	0 / 1383	-18.2	-18.2	0.35 (1)	10.00			
K-J	0 / 0	-18.2	-18.2	0.11 (4)	10.00			

TOP	CH.	LL =	23.3	PSF
		DL =	3.0	PSF
BOT	CH.	LL =	0.0	PSF
		DL =	7.3	PSF
TOTAL LOAD		=	33.6	PSF

LOADING IN FLAT SECTION BASED ON A
SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIQ 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.06")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.19")

CSI: TC=0.30/1.00 (B-C:1), BC=0.35/1.00 (N-O:1),
WB=0.32/1.00 (B-O:1), SS=0.16/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (D) (INPUT = 0.90)
JSI METAL= 0.52 (O) (INPUT = 1.00)



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



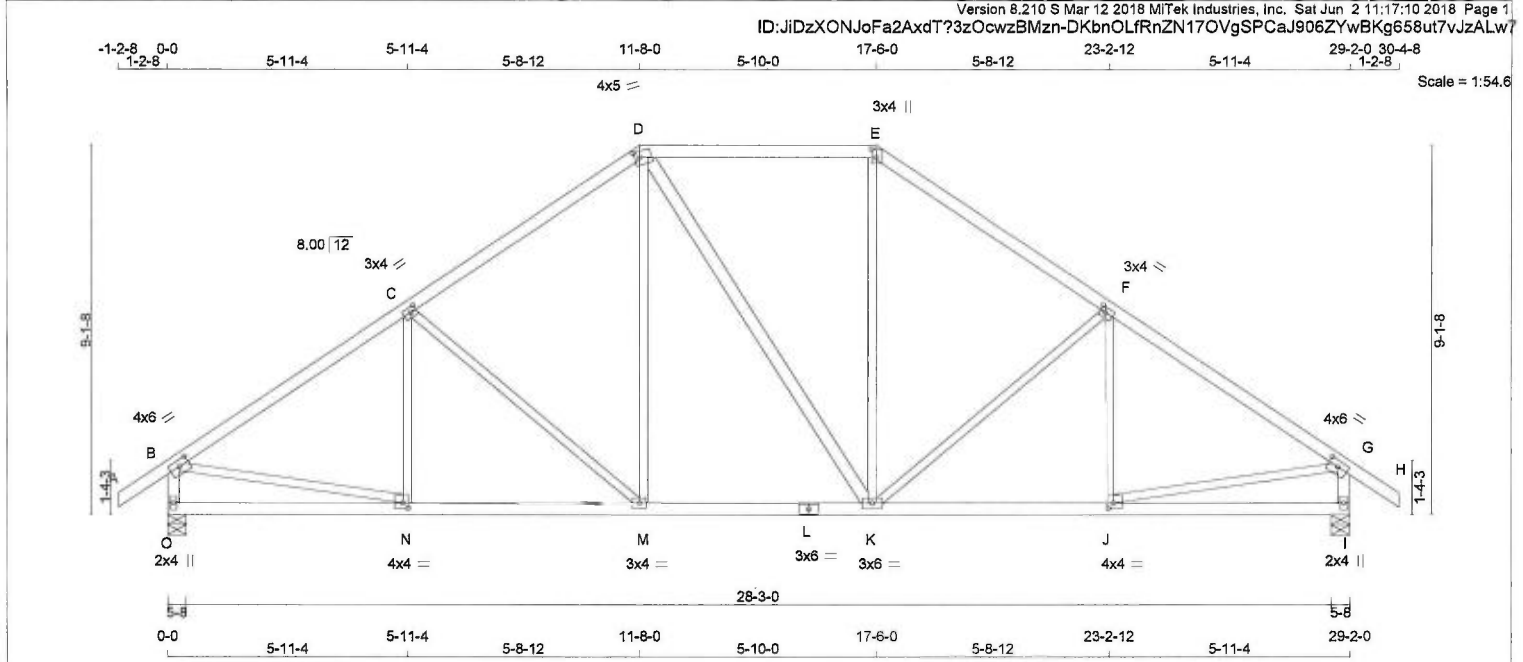

LUMBER

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4 DRY	No.2	SPF
D - E	2x4 DRY	No.2	SPF
E - H	2x4 DRY	No.2	SPF
O - B	2x4 DRY	No.2	SPF
I - G	2x4 DRY	No.2	SPF
O - L	2x4 DRY	No.2	SPF
L - I	2x4 DRY	No.2	SPF
ALL WEBS EXCEPT	2x3 DRY	No.2	SPF
D - K	2x4 DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-I	MT20	4.0	6.0	1.75	3.00
C	TMWW-I	MT20	3.0	4.0	1.50	1.50
D	TTWW-m	MT20	4.0	5.0	1.75	1.50
E	TTW+p	MT20	3.0	4.0	2.50	1.50
F	TMWW-I	MT20	3.0	4.0	1.50	1.50
G	TMVW-I	MT20	4.0	6.0	1.75	3.00
I	BMV1+p	MT20	2.0	4.0		
J	BMWW-I	MT20	4.0	4.0	1.50	1.50
K	BMWWW-I	MT20	3.0	6.0		
L	BS-I	MT20	3.0	6.0		
M	BMWW-I	MT20	3.0	4.0		
N	BMWW-I	MT20	4.0	4.0	1.50	1.50
O	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQRD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
O	1494	0	1494	0	5-8	5-8
I	1494	0	1494	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
O	1047	739 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0
I	1047	739 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, I

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		MAX. UNBRACED LENGTH	MEMB.	WEBS	
	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (PLF)	LC1 MAX (LC)			FORCE (LBS)	MAX. FACTORED (LC)
FR-TO		FROM	TO			FR-TO		
A-B	0 / 28	-77.4	-77.4	0.09 (1)	10.00	N-C	-124 / 63	0.05 (1)
B-C	-1649 / 0	-77.4	-77.4	0.40 (1)	4.75	C-M	-379 / 0	0.45 (1)
C-D	-1364 / 0	-77.4	-77.4	0.37 (1)	5.15	M-D	0 / 349	0.08 (1)
D-E	-1113 / 0	-77.4	-77.4	0.36 (1)	5.57	D-K	0 / 0	0.00 (1)
E-F	-1365 / 0	-77.4	-77.4	0.37 (1)	5.15	K-E	0 / 350	0.08 (1)
F-G	-1649 / 0	-77.4	-77.4	0.40 (1)	4.75	K-F	-379 / 0	0.45 (1)
G-H	0 / 28	-77.4	-77.4	0.09 (1)	10.00	J-F	-125 / 63	0.05 (1)
O-B	-1449 / 0	0.0	0.0	0.15 (1)	6.79	B-N	0 / 1417	0.32 (1)
I-G	-1449 / 0	0.0	0.0	0.15 (1)	6.79	J-G	0 / 1417	0.32 (1)
O-N	0 / 0	-18.2	-18.2	0.15 (4)	10.00			
N-M	0 / 1397	-18.2	-18.2	0.30 (1)	10.00			
M-L	0 / 1112	-18.2	-18.2	0.24 (1)	10.00			
L-K	0 / 1112	-18.2	-18.2	0.24 (1)	10.00			
K-J	0 / 1396	-18.2	-18.2	0.30 (1)	10.00			
J-I	0 / 0	-18.2	-18.2	0.15 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CSI: TC=0.40/1.00 (B-C:1), BC=0.30/1.00 (M-N:1), WB=0.45/1.00 (C-M:1), SSI=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (E) (INPUT = 0.90)
JSI METAL= 0.52 (N) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



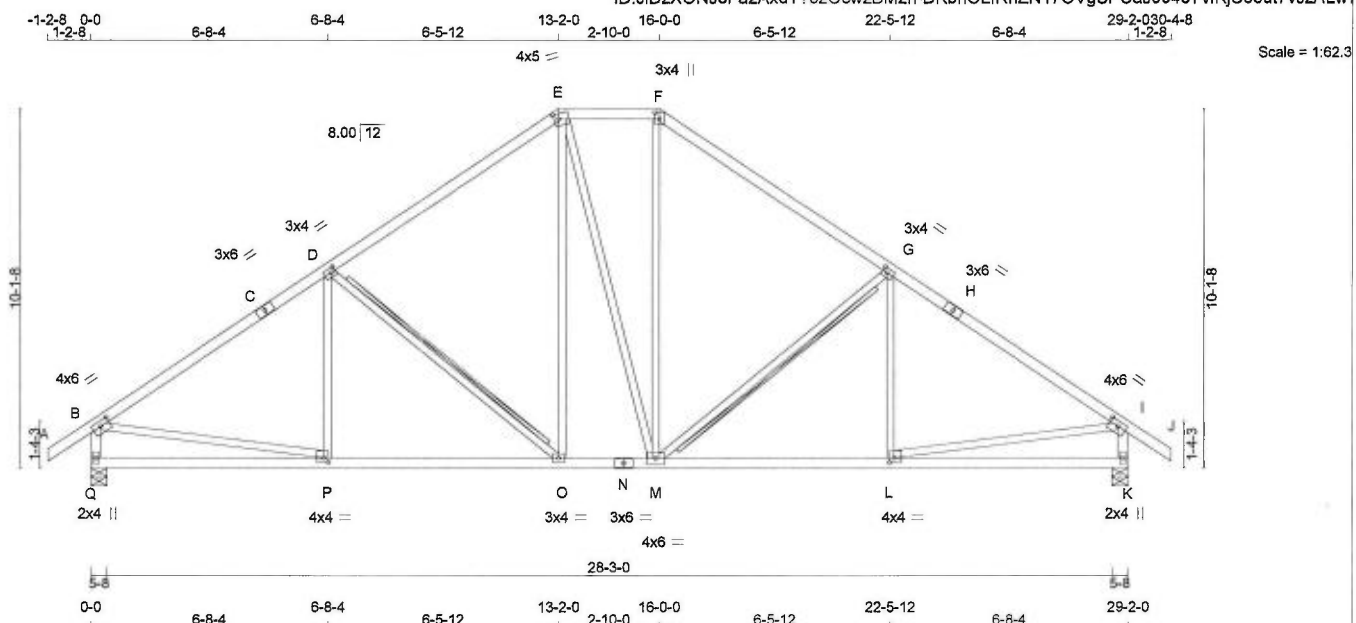

TOTAL WEIGHT = 134 lb

LUMBER		N. L. G. A. RULES			
CHARS	SIZE		LUMBER		DESCR.
A - C	2x4	DRY	No.2		SPF
C - E	2x4	DRY	No.2		SPF
E - F	2x4	DRY	No.2		SPF
F - H	2x4	DRY	No.2		SPF
H - J	2x4	DRY	No.2		SPF
J - Q	2x4	DRY	No.2		SPF
Q - K	2x4	DRY	No.2		SPF
K - N	2x4	DRY	No.2		SPF
N - K	2x4	DRY	No.2		SPF

ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
--------------------	-----	-----	------	-----

DRY: SEASONED LUMBER.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-t	MT20	4.0	6.0	1.75	3.00
C	TS-t	MT20	3.0	6.0		
D	TMWV-t	MT20	3.0	4.0	1.50	1.50
E	TTWV-m	MT20	4.0	5.0	1.75	1.50
F	TTW+p	MT20	3.0	4.0	2.25	1.50
G	TMWV-t	MT20	3.0	4.0	1.50	1.50
H	TS-t	MT20	3.0	6.0		
I	TMWV-t	MT20	4.0	6.0	1.75	3.00
K	BMV1+p	MT20	2.0	4.0		
L	BMWV-t	MT20	4.0	4.0	1.50	1.50
M	BMWVWV-t	MT20	4.0	6.0		
N	BS-t	MT20	3.0	6.0		
O	BMWV-t	MT20	3.0	4.0		
P	BMWV-t	MT20	4.0	4.0	1.50	1.50
Q	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
JT	VERT	DOWN	HORZ	UPLIFT	IN-SX
K	1494	0	1494	0	5-8
Q	1494	0	1494	0	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
Q	1047	739 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0
K	1047	739 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.59 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT D-O. G-M

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

C H O R D S					W E B S				
MAX. FACTORED		FACTORED			MAX. FACTORED				
MEMB.	FORCE	VERT. LOAD	LC1	MAX	MAX.	MEMB.	FORCE	MAX.	
	(LBS)	(PLF)	CSI (LC)	UNBRAC			(LBS)	CSI (LC)	
FR-TO		FROM	TO	LENGTH	FR-TO				
A-B	0 / 28	-77.4	-77.4	0.09 (1)	10.00	P-D	-75 / 94	0.04 (1)	
B-C	-1647 / 0	-77.4	-77.4	0.53 (1)	4.59	D-O	-486 / 0	0.28 (1)	
C-D	-1647 / 0	-77.4	-77.4	0.53 (1)	4.59	O-E	0 / 384	0.09 (1)	
D-E	-1268 / 0	-77.4	-77.4	0.48 (1)	5.13	E-M	0 / 5	0.00 (1)	
E-F	-1030 / 0	-77.4	-77.4	0.09 (1)	6.09	M-F	0 / 389	0.09 (1)	
F-G	-1270 / 0	-77.4	-77.4	0.48 (1)	5.13	M-G	-484 / 0	0.27 (1)	
G-H	-1646 / 0	-77.4	-77.4	0.53 (1)	4.59	L-G	-78 / 93	0.04 (1)	
H-I	-1646 / 0	-77.4	-77.4	0.53 (1)	4.59	B-P	0 / 1415	0.32 (1)	
I-J	0 / 28	-77.4	-77.4	0.09 (1)	10.00	L-I	0 / 1414	0.32 (1)	
Q-B	-1445 / 0	0.0	0.0	0.15 (1)	6.80				
K-I	-1444 / 0	0.0	0.0	0.15 (1)	6.80				
Q-P	0 / 0	-18.2	-18.2	0.21 (4)	10.00				
P-O	0 / 1399	-18.2	-18.2	0.33 (1)	10.00				
O-N	0 / 1029	-18.2	-18.2	0.23 (1)	10.00				
N-M	0 / 1029	-18.2	-18.2	0.23 (1)	10.00				
M-L	0 / 1398	-18.2	-18.2	0.33 (1)	10.00				
L-K	0 / 0	-18.2	-18.2	0.20 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.3	PSF
TOTAL LOAD	=	33.6	PSF

TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A
SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIQ 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.06")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.13")

CSI: TC=0.53/1.00 (B-D:1) , BC=0.33/1.00 (O-P:1) ,
WB=0.32/1.00 (B-P:1) , SSI=0.21/1.00 (B-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES						
PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg

JSI GRIP= 0.90 (F) (INPUT = 0.90)



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



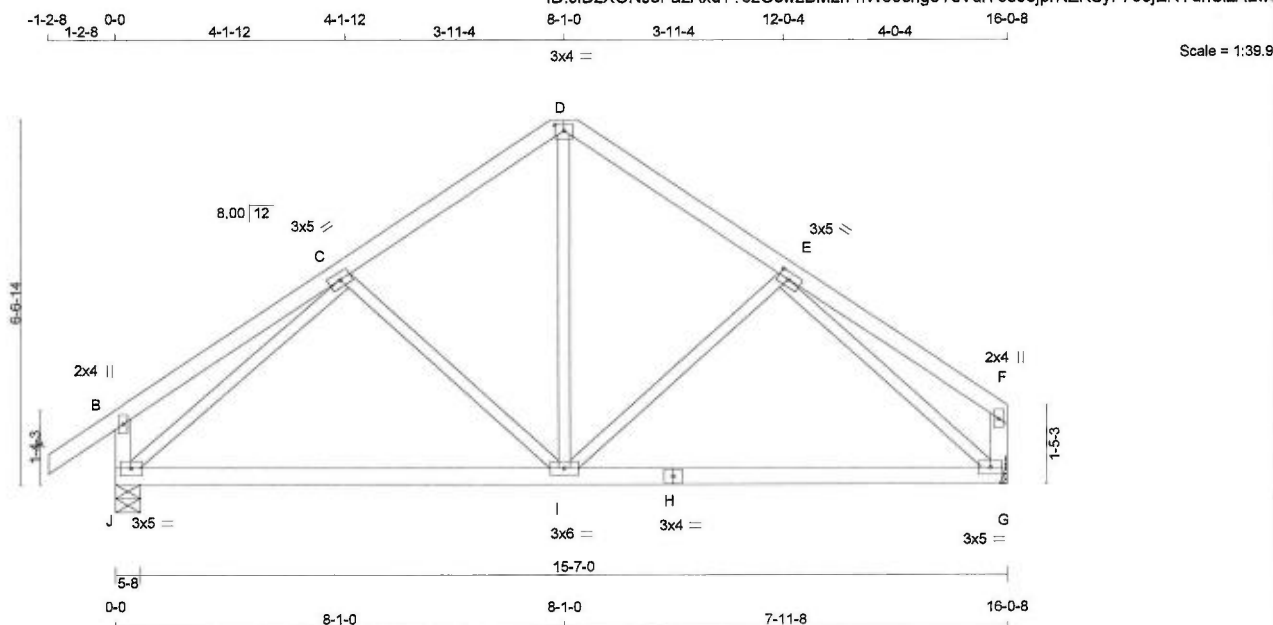

TOTAL WEIGHT = 66 lb

LUMBER		LUMBER		DESCR	
N L G A.	RULES				
CHORDS	SIZE				
A - D	2x4	DRY	No.2		SPF
D - F	2x4	DRY	No.2		SPF
J - B	2x4	DRY	No.2		SPF
G - F	2x4	DRY	No.2		SPF
J - H	2x4	DRY	No.2		SPF
H - G	2x4	DRY	No.2		SPF
ALL WEBS	2x3	DRY	No.2		SPF
EXC FRT					

DRY: SEASONED LUMBER.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+P	MT20	2.0	4.0		
C	MTMW-t	MT20	3.0	5.0		
D	TTW-p	MT20	3.0	4.0	1.25	2.00
E	MTMW-t	MT20	3.0	5.0	1.50	2.25
F	TMV+P	MT20	2.0	4.0		
G	BMVW1-t	MT20	3.0	5.0		
H	BS-t	MT20	3.0	4.0		
I	BMVWW-t	MT20	3.0	6.0		
J	BMVW1-t	MT20	3.0	5.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED			INPUT	REQRD
	GROSS REACTION		GROSS REACTION			BRG		BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
J	867	0	867	0	0	5-8	5-8	
G	767	0	767	0	0	MECHANICAL		

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT G TO RESIST THE MAX. FACTORED REACTIONS.

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	607	434 / 0	0 / 0	0 / 0	0 / 0	173 / 0	0 / 0
G	539	374 / 0	0 / 0	0 / 0	0 / 0	165 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	LC1 (LBS)	MAX. UNBRAC. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRAC. CSI (LC)		
FR-TO		FROM	TO	LENGTH	FR-TO				
A-B	0/28	-77.4	-77.4	0.09 (1)	10.00	C-I	-190/2	0.10 (1)	
B-C	0/20	-77.4	-77.4	0.20 (1)	10.00	I-D	0/425	0.10 (1)	
C-D	-622/0	-77.4	-77.4	0.16 (1)	6.25	I-E	-172/6	0.09 (1)	
D-E	-621/0	-77.4	-77.4	0.15 (1)	6.25	J-C	-871/0	0.43 (1)	
E-F	0/20	-77.4	-77.4	0.19 (1)	10.00	E-G	-866/0	0.41 (1)	
J-B	-220/0	0.0	0.0	0.02 (1)	7.81				
G-F	-115/0	0.0	0.0	0.01 (1)	7.81				
J-I	0/641	-18.2	-18.2	0.38 (4)	10.00				
I-H	0/627	-18.2	-18.2	0.38 (4)	10.00				
H-G	0/627	-18.2	-18.2	0.38 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH,	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH,	LL =	0.0	PSF
	DL =	7.3	PSF
TOTAL LOAD	=	33.6	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.53")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.53")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.10")

CSI: TC=0.20/1.00 (B-C:1) , BC=0.38/1.00 (I-J:4) ,
WB=0.43/1.00 (C-J:1) , SSI=0.13/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES						
PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (C) (INPUT = 0.90)
JSI METAL= 0.24 (C) (INPUT = 1.00)



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



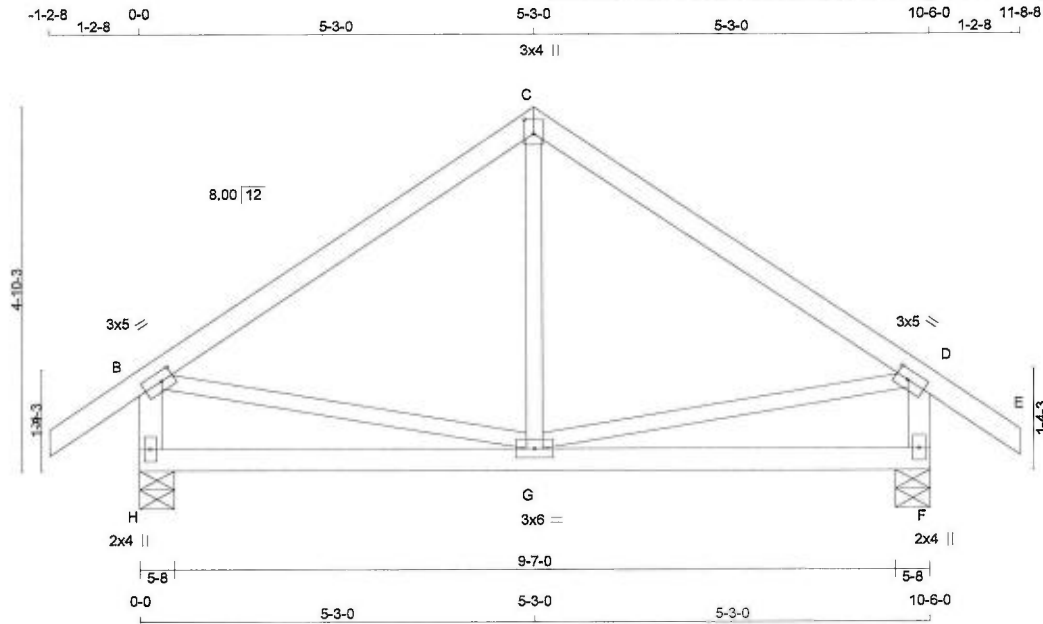

Scale = 1:29.5

TOTAL WEIGHT = 44 lb
[M][F]

LUMBER				LUMBER	DESCR.
N. L. G. A. RULES	CHORDS	SIZE	DRY		
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
H - B	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-H	MT20	3.0	5.0	1.50	2.00
C	TTW+P	MT20	3.0	4.0	2.25	1.50
D	TMVW-H	MT20	3.0	5.0	1.50	2.00
F	BMV1+P	MT20	2.0	4.0		
G	BMVWV-H	MT20	3.0	6.0		
H	BMV1+P	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
H	602	0	602	0	5-8	5-8
F	602	0	602	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
H	420	305 / 0	0 / 0	0 / 0	0 / 0	116 / 0	0 / 0
F	420	305 / 0	0 / 0	0 / 0	0 / 0	116 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX FACTORED CSI (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 28	-77.4	-77.4 0.09 (1)	10.00	G-C	-1 / 93	0.03 (4)
B-C	-365 / 0	-77.4	-77.4 0.27 (1)	6.25	B-G	0 / 310	0.07 (1)
C-D	-365 / 0	-77.4	-77.4 0.27 (1)	6.25	G-D	0 / 310	0.07 (1)
D-E	0 / 28	-77.4	-77.4 0.09 (1)	10.00			
H-B	-565 / 0	0.0	0.0 0.06 (1)	7.81			
F-D	-565 / 0	0.0	0.0 0.06 (1)	7.81			
H-G	0 / 0	-18.2	-18.2 0.14 (4)	10.00			
G-F	0 / 0	-18.2	-18.2 0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 23.3 PSF
DL	= 3.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.3 PSF
TOTAL LOAD	= 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.27/1.00 (B-C:1), BC=0.14/1.00 (F-G:4),
WB=0.07/1.00 (D-G:1), SSI=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX MIN
MT20	618	354	1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.68 (G) (INPUT = 0.90)
JSI METAL= 0.16 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



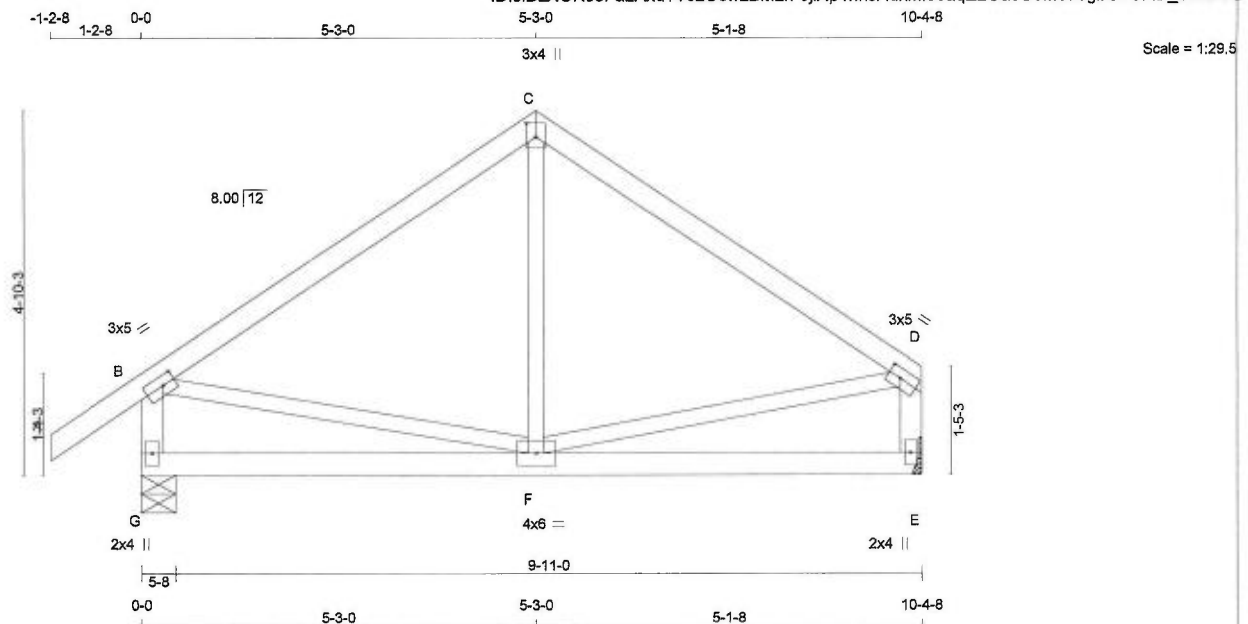

TOTAL WEIGHT = 2 X 42 = 83 lb
[M][F]

<u>LUMBER</u>					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR.
A - C	2x4	DRY	No.2		SPF
C - D	2x4	DRY	No.2		SPF
G - B	2x4	DRY	No.2		SPF
E - D	2x4	DRY	No.2		SPF
G - E	2x4	DRY	No.2		SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	3.0	5.0	1.50 2.00
C	TTW+p	MT20	3.0	4.0	2.25 1.50
D	TMVW-t	MT20	3.0	5.0	1.50 2.00
E	BMV1+p	MT20	2.0	4.0	
F	BMVWW-t	MT20	4.0	6.0	
G	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
G	596	0	596	0	5-8	5-8
E	496	0	496	0	0	MECHANICAL

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT E TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
G	416	302 / 0	0 / 0	0 / 0	0 / 0	115 / 0	0 / 0
E	348	242 / 0	0 / 0	0 / 0	0 / 0	107 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	LC1 MAX (LC)	MAX. UNBRAC LENGTH	
FR-TO		FROM TO			FR-TO				
A - B	0 / 28	-77.4	-77.4	0.09 (1)	10.00	F - C	-6 / 90	0.03 (4)	
B - C	-356 / 0	-77.4	-77.4	0.27 (1)	6.25	B - F	0 / 302	0.07 (1)	
C - D	-356 / 0	-77.4	-77.4	0.26 (1)	6.25	F - D	0 / 303	0.07 (1)	
G - B	-559 / 0	0.0	0.0	0.06 (1)	7.81				
E - D	-460 / 0	0.0	0.0	0.05 (1)	7.81				
G - F	0 / 0	-18.2	-18.2	0.14 (4)	10.00				
F - E	0 / 0	-18.2	-18.2	0.14 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.3	PSF
TOTAL LOAD = 33.6 PSF				

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.35")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.35")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.02")

CSI: TC=0.27/1.00 (B-C:1), BC=0.14/1.00 (E-F:4), WB=0.07/1.00 (D-F:1), SSI=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1667	822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.51 (B) (INPUT = 0.90)
JSI METAL= 0.16 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



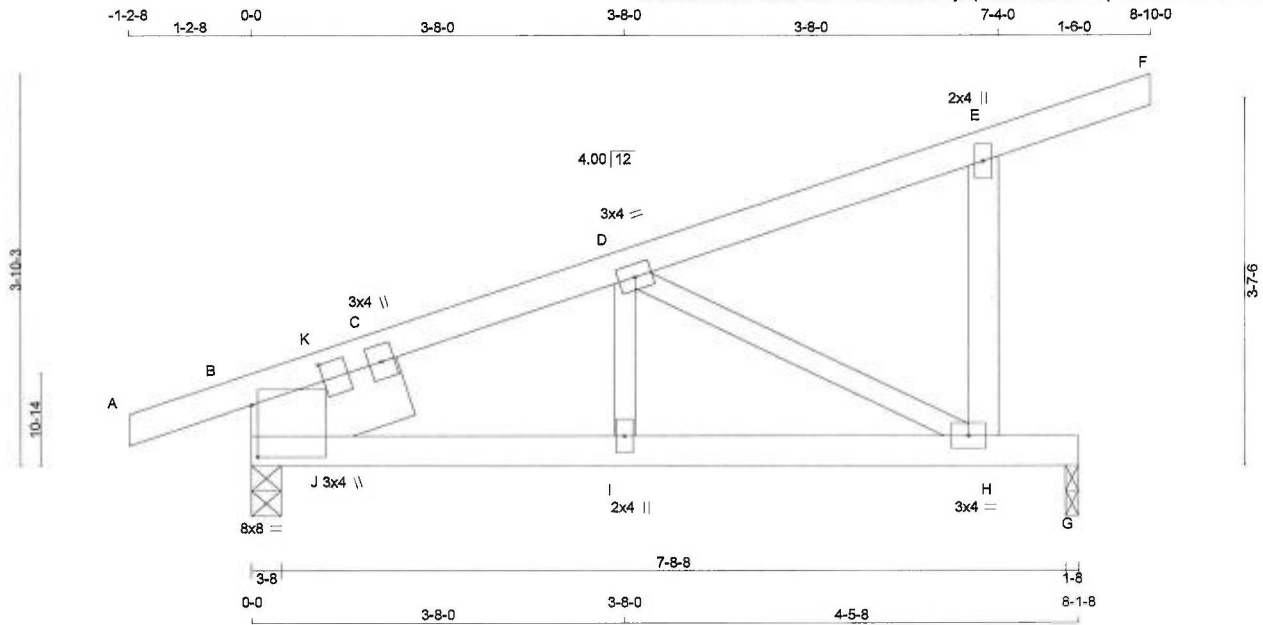

Scale = 1:21.8

TOTAL WEIGHT = 9 X 33 = 293 lb [M][F]

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - F	2x4 DRY	No.2	SPF
H - E	2x4 DRY	No.2	SPF
B - G	2x4 DRY	No.2	SPF
REINFORCING MEMBERS			
HW1	2x8 DRY	No.2	SPF
ALL WEBS 2x3 DRY			
SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMBMR1-I	MT20	8.0	8.0	6.25 0.75
B	RT+I	MT20	3.0	4.0	2.00 9.00
B	RT+I	MT20	3.0	4.0	
D	TMMW-I	MT20	3.0	4.0	
E	TMV+p	MT20	2.0	4.0	
H	BMVW-I	MT20	3.0	4.0	
I	BMW+V	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
B	494	0	494	0	0	3-8	3-8	3-8	3-8
G	438	0	438	0	0	1-8	1-8	1-8	1-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN.	COMPONENT REACTIONS	DEAD	SOIL
B	345	253 / 0	0 / 0	0 / 0	92 / 0
G	307	219 / 0	0 / 0	0 / 0	88 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX LC1 (LC)	MEMB.
FR-TO		FROM TO		FR-TO			
A-B	-7 / 0	-77.4 -77.4	0.06 (1)	I-D	0 / 199	0.04 (1)	
B-K	-516 / 0	-77.4 -77.4	0.01 (1)	D-H	-581 / 0	0.15 (1)	
K-C	-413 / 0	-77.4 -77.4	0.12 (1)	J-K	0 / 418	0.00 (1)	
C-D	-413 / 0	-77.4 -77.4	0.12 (1)	J-C	-420 / 0	0.02 (1)	
D-E	-4 / 0	-77.4 -77.4	0.13 (1)				
E-F	-19 / 0	-77.4 -77.4	0.10 (1)				
H-E	-248 / 0	0.0 0.0	0.04 (1)				
B-J	0 / 337	-18.2 -18.2	0.08 (1)				
J-I	0 / 520	-18.2 -18.2	0.20 (1)				
I-H	0 / 520	-18.2 -18.2	0.55 (1)				
H-G	0 / 0	-18.2 -18.2	0.46 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
	DL = 3.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.3	PSF
TOTAL LOAD	= 33.6	PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= $\frac{1}{360}$ (0.27")
CALCULATED VERT. DEFL.(LL) = $\frac{1}{999}$ (0.07")
ALLOWABLE DEFL.(TL)= $\frac{1}{360}$ (0.27")
CALCULATED VERT. DEFL.(TL) = $\frac{1}{795}$ (0.12")

CSI: TC=0.13/1.00 (D-E:1), BC=0.55/1.00 (H-I:1), WB=0.15/1.00 (D-H:1), SS=0.34/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.79 (H) (INPUT = 0.90)
JSI METAL= 0.19 (H) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.




BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B37579H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON	3.00	0.144	132	147
WIRE	3.25	0.144	132	147
	3.50	0.160	159	177

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-09, section 10.9.4.1.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-09, section 10.9.4
10. This design is not valid after April 30, 2019.

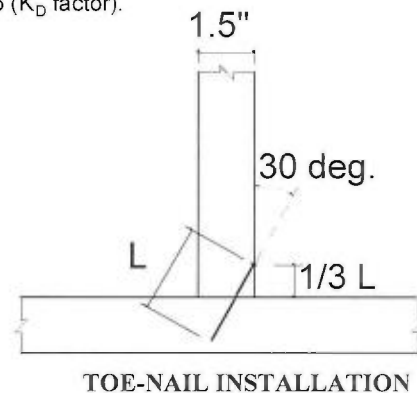

Nail type	Common wire	Common spiral	Common wire
Nail dia. (in)	0.160	0.152	0.144
	(3.5" nail)		(3" and 3.25" nail)
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS		
2X4 SPF	2	2	3
2X4 D. Fir	2	2	2
2X6 SPF	4	4	4
2X6 D. Fir	3	3	3



MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

PEO
Certificate No. 10889485



April 26, 2017

BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B37579H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind or earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-09, section 10.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-09, section 10.9.5
9. This design is not valid after April 30, 2019

Toe-nailing on 2x6 Bearing Plate

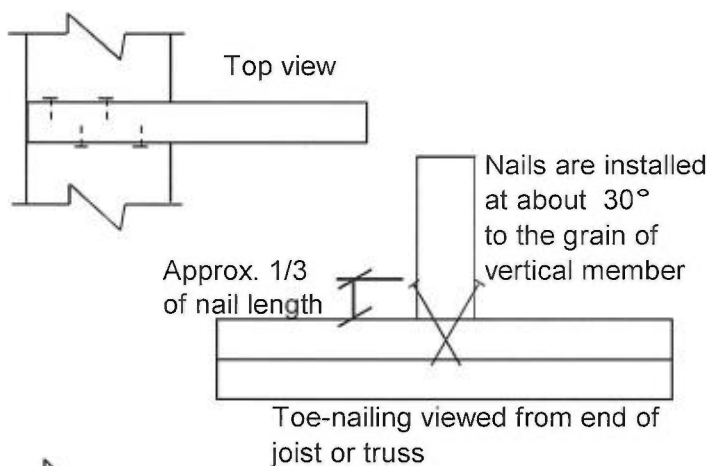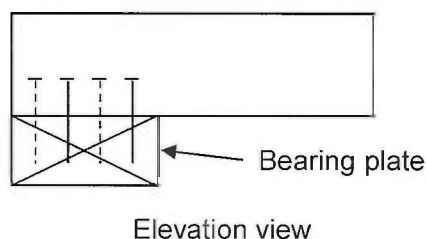

Toe-nailing on 2x4 Bearing Plate

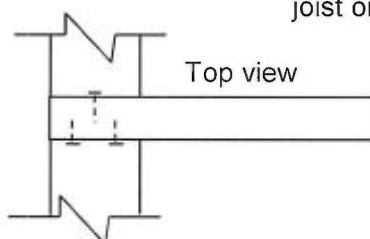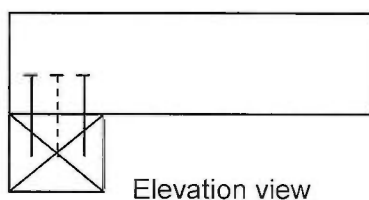

MiTek Canada Inc
100 Industrial Rd.
Bradford Ontario L3Z 3G7

PEO
Certificate No. 10889485



April 26, 2017