

NE0618-10**GREEN YORK HOMES - GRANELLI
HOME CORP - CELESTIAL 1 ELEV 2****RESPONSIBILITIES**

THIS DESIGN IS FOR AN INDIVIDUAL BUILDING COMPONENT AND HAS BEEN BASED ON INFORMATION PROVIDED BY THE DESIGN OFFICE OF KOTT LUMBER. THE UNDERSIGNED ENGINEER DISCLAIMS ANY RESPONSIBILITY FOR DAMAGES AS A RESULT OF FAULTY OR INCORRECT INFORMATION, SPECIFICATION AND/OR DESIGNS FURNISHED TO THE ENGINEER. THE UNDERSIGNED ENGINEER IS ONLY RESPONSIBLE FOR THE STRUCTURAL INTEGRITY OF THIS BUILDING COMPONENT FOR THE CONDITIONS AND LOADS SHOWN ON THIS DRAWING. THE STRUCTURAL INTEGRITY OF THE BUILDING AND THE VERIFICATION OF THE DIMENSIONS AND THE DESIGN LOADS USED ARE THE RESPONSIBILITY OF THE BUILDING DESIGNER.

TRUSSES ARE DESIGNED IN CONFORMANCE WITH THE RELEVANT SECTIONS OF THE NATIONAL BUILDING CODE OF CANADA OR THE CANADIAN CODE FOR FARM BUILDINGS, WHICHEVER APPLIES TO THE BUILDING TYPE INDICATED ON THE DRAWING

IT IS THE RESPONSIBILITY OF KOTT LUMBER TO ENSURE THAT TRUSSES ARE MANUFACTURED IN CONFORMANCE WITH THESE DESIGNS AND WITH THE SPECIFICATIONS OUTLINED BELOW. THE UNDERSIGNED ENGINEER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

USE AND OCCUPANCY

- The building is of the type indicated on the drawing

LOADING

- The truss loading intensity and distribution as well as load transfer mechanism is that indicated on the drawing
- No buildings, trees, parapets or other projections higher than the roof for which the trusses are used are located within a distance less than ten (10) times the difference in height, or five metres (16 ft) whichever is greater, unless the drawing indicates that the snow drifting has been taken into account

HANDLING, INSTALLATION AND BRACING

- The trusses must be handled and installed by a qualified professional as per the supplied document titled *Information for Truss Installers* and the BCSI-B1 and BCSI-B3 Summary Sheets
- The compression chords are laterally braced by continuous rigid diaphragm sheathing or as specified on the drawing
- Temporary and permanent bracing must be installed as indicated on the truss drawing and according to the BCSI-B1 and BCSI-B3 Summary Sheets. Bracing for the lateral stability of the truss is to be provided by the building designer
- **It is recommended that a Professional Engineer's advice be obtained for the bracing of trusses spanning more than 12.37m (40'-7")**

SUPPORTS

- The trusses are to be supported at the bearing points indicated and anchored to the supports where considered necessary by the designer of the overall structure
- Bearing sizes shown are the minimum required to prevent crushing of the truss members and do not necessarily take into account stability of the overall building structure
- Elevation of bearings must be carefully checked and shimmed to alignment for solid bearings
- Adequate wood truss bearing is the responsibility of the building designer.

DIMENSIONS

- Geometry of the truss and dimensions indicated on the drawing are identical to those of the installed truss.


For conventional framing roof / ceilings
framing shall conform to OBC.9.23


Layout based on plans provided by
Jardin Design Group Inc.
Revision #2 dated May 22, 2018

THIS CERTIFICATION IS FOR THE ENGINEERING REVIEW OF STRUCTURAL COMPONENTS SHOWN ON THIS DRAWING AND IS LIMITED TO THE COMPONENTS SUPPLIED BY KOTT LUMBER FOR THE LOADS AND CONDITIONS SHOWN ON THE CALCULATION PAGE OF EACH COMPONENT. THE PLACEMENT OF THESE COMPONENTS ON THIS LAYOUT IS SHOWN FOR REFERENCE ONLY. ROOF TRUSSES MUST BE INSTALLED ACCORDING TO MANUFACTURER'S GUIDELINES AT 24" C/C UNLESS NOTED OTHERWISE. CONVENTIONAL FRAMING SHOWN ON THE LAYOUT MUST BE DESIGNED AND APPROVED BY THE PROJECT ENGINEER. TEMPORARY AND PERMANENT BRACINGS OF THE ROOF AND BUILDING ARE THE RESPONSIBILITY OF THE PROJECT ENGINEER AND TO CONFORM TO BCSI GUIDELINES.



ENG.JOB:NE0618-010

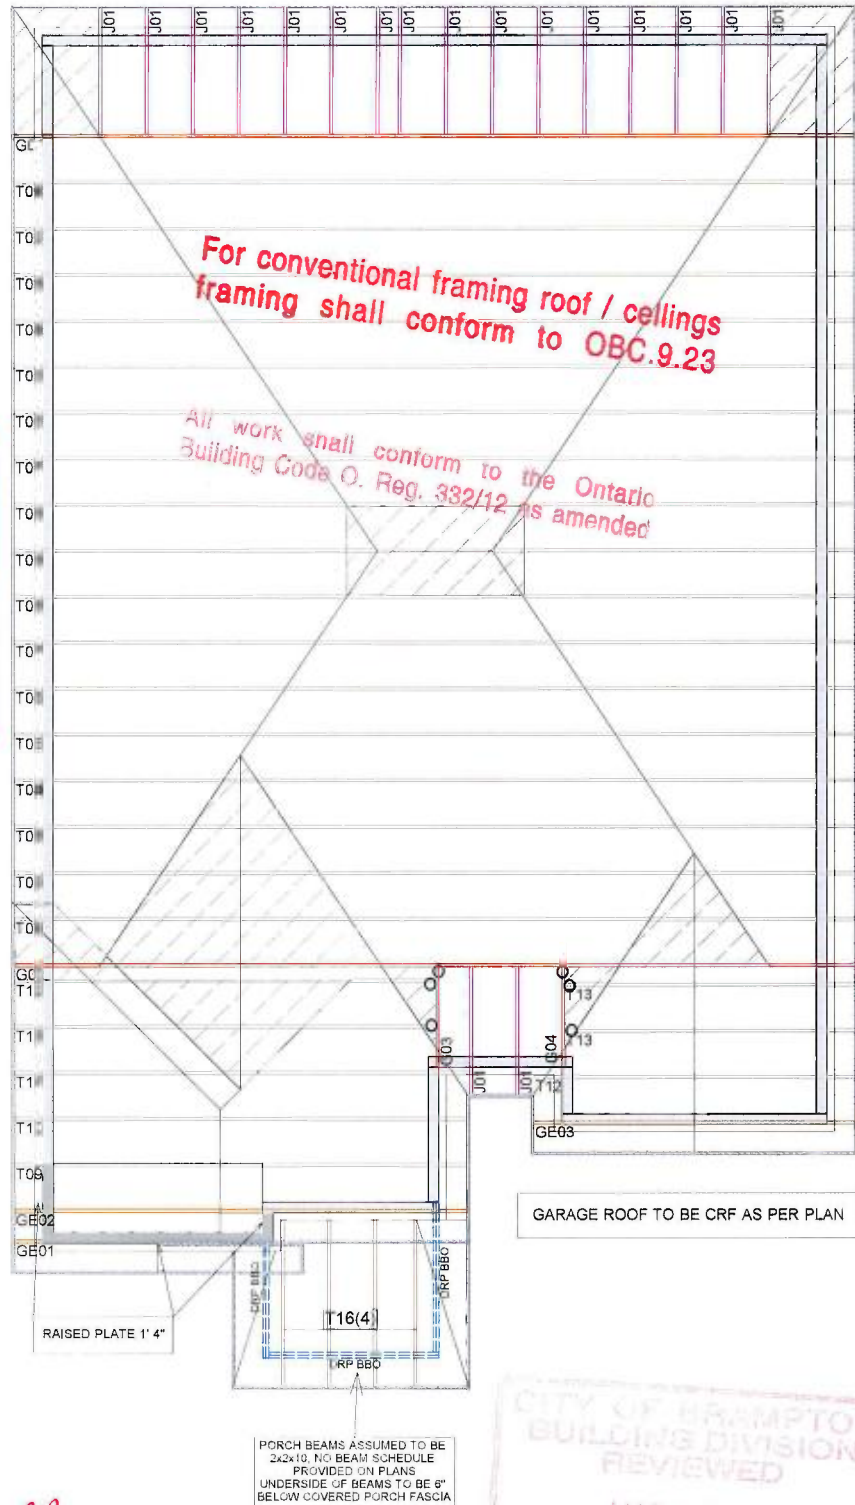

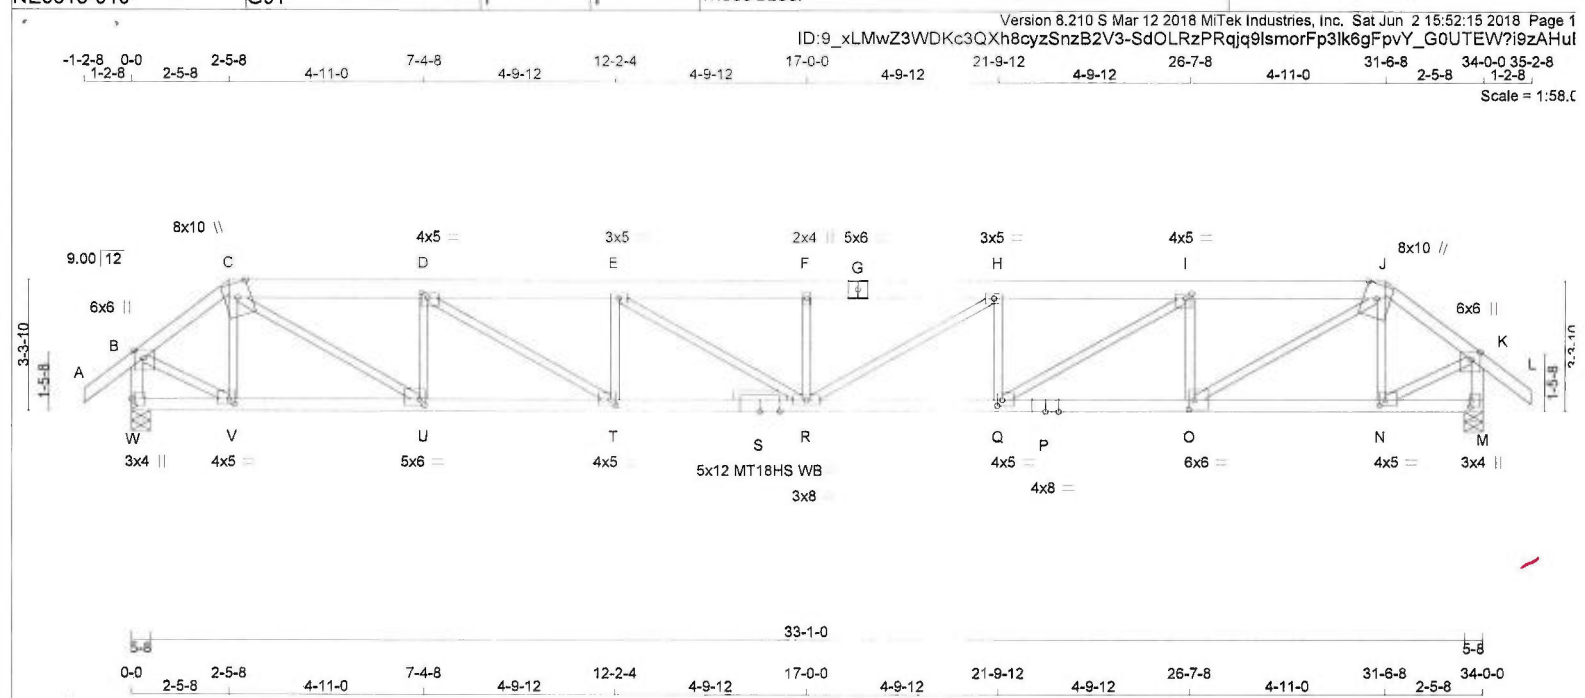

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES				BEARINGS				SPECIFIED LOADS:			
CHORDS	SIZE	LUMBER	DESCR.	FACTORED				TOP CH. LL = 23.3 PSF			
A - C	2x4	No.2	SPF	GROSS REACTION				DL = 3.0 PSF			
C - G	2x6	No.2	SPF	DOWN				BOT CH. LL = 0.0 PSF			
G - J	2x6	No.2	SPF	UP				DL = 7.3 PSF			
J - L	2x4	No.2	SPF	REACT				TOTAL LOAD = 33.6 PSF			
W - B	2x4	No.2	SPF	FACTORED				SPACING = 24.0 IN. C/C			
M - K	2x4	No.2	SPF	GROSS REACTION				LOADING IN FLAT SECTION BASED ON A			
W - S	2x4	2100F 1.8E	SPF	DOWN				SLOPE OF 2.00/12 MINIMUM			
S - P	2x4	2100F 1.8E	SPF	UP				GIRDER TYPE: CPrimeHip			
P - M	2x4	No.2	SPF	REACT				SIDE SETBACK = 2-5-8			
ALL WEBS 2x3 DRY No.2 SPF				UNFACTORED REACTIONS				END SETBACK = 4-4-4			
EXCEPT				1ST LCASE				END WALL WIDTH = 5-8			
DRY: SEASONED LUMBER.				MAX./MIN. COMPONENT REACTIONS				CORNER FRAMING TYPE: CONVENTIONAL			
				JT COMBINED				END JACK TYPE: CONVENTIONAL			
				W 1752 1228 / 0 0 / 0 0 / 0 524 / 0 0 / 0				APPLIED TO FRONT SIDE			
				M 1752 1228 / 0 0 / 0 0 / 0 524 / 0 0 / 0				- ADT'L LOADS BASED ON 55 % OF GSL.			
				TOTAL LOAD CASES: (4)				THIS TRUSS IS DESIGNED FOR RESIDENTIAL			
								OR SMALL BUILDING REQUIREMENTS OF			
								PART 9, NBCC 2010			
								THIS DESIGN COMPLIES WITH:			
								- PART 9 OF OBC 2012, BCBC 2012, ABC 2014			
								- CSA 086-09			
								- TPIC 2011			
								(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F.			
								RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED			
								ROOF LIVE LOAD			
								ALLOWABLE DEFL.(LL)= L/360 (1.13")			
								CALCULATED VERT. DEFL.(LL) = L/958 (0.43")			
								ALLOWABLE DEFL.(TL)= L/360 (1.13")			
								CALCULATED VERT. DEFL.(TL) = L/542 (0.75")			
								CSI: TC=0.53/1.00 (E-F:1), BC=0.94/1.00 (O-Q:1),			
								WB=0.84/1.00 (J-O:1), SSI=0.21/1.00 (C-D:1)			
								DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00			
								COMP=1.00 SHEAR=1.00 TENS= 1.00			
								COMPANION LIVE LOAD FACTOR = 0.50			
								TRUSS PLATE MANUFACTURER IS NOT			
								RESPONSIBLE FOR QUALITY CONTROL IN			
								THE TRUSS MANUFACTURING PLANT.			
								NAIL VALUES			
								PLATE GRIP(DRY) SHEAR SECTION			
								(PSI) (PLI) (PLI)			
								MAX MIN MAX MIN MAX MIN			
								MT20 618 354 1667 822 2284 1656			
								MT18HS 580 354 2729 1405 4191 2010			

PLATES (table is in inches)				CHORDS				WEBS			
JT TYPE	PLATES	W	LEN	Y	X	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 MAX (PLF)	MAX. UNBRACED LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)
B TMVW+p	MT20	6.0	6.0	2.25	2.75	A-B	0 / 30	-77.4 -77.4 0.10 (1)	10.00	V-C	-721 / 0
C TTWW+m	MT20	8.0	10.0	Edge		B-C	-2414 / 0	-77.4 -77.4 0.17 (1)	4.25	C-U	0 / 3399
D TMVW-t	MT20	4.0	5.0	1.50	1.75	C-D	-4829 / 0	-114.0 -114.0 0.37 (1)	3.66	U-D	-1631 / 0
E TMVW-t	MT20	3.0	5.0			D-E	-6475 / 0	-114.0 -114.0 0.46 (1)	3.14	D-T	0 / 1927
F TMVW-w	MT20	2.0	4.0			E-F	-7037 / 0	-114.0 -114.0 0.53 (1)	2.94	T-E	-871 / 0
G TS-t	MT20	5.0	6.0			F-G	-7037 / 0	-114.0 -114.0 0.53 (1)	2.94	E-R	0 / 658
H TMVW-t	MT20	3.0	5.0			G-H	-7037 / 0	-114.0 -114.0 0.53 (1)	2.94	R-F	-556 / 0
I TMVW-t	MT20	4.0	5.0	1.50	1.75	H-I	-6478 / 0	-114.0 -114.0 0.46 (1)	3.14	F-H	0 / 655
J TTWW+m	MT20	8.0	10.0	Edge		I-J	-4827 / 0	-114.0 -114.0 0.38 (1)	3.66	H-Q	-873 / 0
K TMVW+p	MT20	6.0	6.0	2.25	2.75	J-K	-2411 / 0	-77.4 -77.4 0.17 (1)	4.25	Q-I	0 / 1932
M BMV1+p	MT20	3.0	4.0	2.00	0.25	K-L	0 / 30	-77.4 -77.4 0.10 (1)	10.00	I-L	-1627 / 0
N BMVW-t	MT20	4.0	5.0	1.50	1.50	W-B	-2487 / 0	0.0 0.0 0.28 (1)	5.37	O-J	0 / 3400
O BMVW-t	MT20	6.0	6.0	2.75	1.50	M-K	-2484 / 0	0.0 0.0 0.28 (1)	5.37	N-J	-726 / 0
P BS-t	MT20	4.0	8.0							B-V	0 / 2120
Q BMVW-t	MT20	4.0	5.0	1.75	1.50					N-K	0 / 2117
R BMVW-t	MT20	3.0	8.0								
S BS-t	MT18HS	5.0	12.0								
T BMVW-t	MT20	4.0	5.0	1.75	1.50						
U BMVW-t	MT20	5.0	6.0	1.75	1.50						
V BMVW-t	MT20	4.0	5.0	1.50	1.50						
W BMV1+p	MT20	3.0	4.0	2.00	0.75						
Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.				FACTORED CONCENTRATED LOADS (LBS)				FACE DIR. TYPE			
				JT LOC. LC1 MAX- MAX+				TOTAL TOTAL			
				C 2-5-8 -90 -90				FRONT VERT TOTAL			
				J 31-6-8 -90 -90				FRONT VERT TOTAL			

WB - INDICATES BLOCKING REQUIRED

HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 90.5 lbs FACTORED DOWN AT 31-6-8, AND 90.5 lbs FACTORED DOWN AT 2-5-8 ON TOP CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.89 (O) (INPUT = 0.90)
JSI METAL= 0.94 (P) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

CONTINUED ON PAGE 2



PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
V	BMV1+p	MT20	3.0	5.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.


HANGERS NOTES

1) SPECIAL HANGER(S) OR CONNECTION(S)
REQUIRED TO SUPPORT CONCENTRATED
LOAD(S) 966.4 lbs FACTORED DOWN AT 17-1-4,
AND 671.8 lbs FACTORED DOWN AT 22-6-12 ON
BOTTOM CHORD. DESIGN FOR UNSPECIFIED
CONNECTION(S) IS DELEGATED TO THE
BUILDING DESIGNER.

PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.89 (E) (INPUT = 0.90)
JSI METAL= 0.97 (P) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



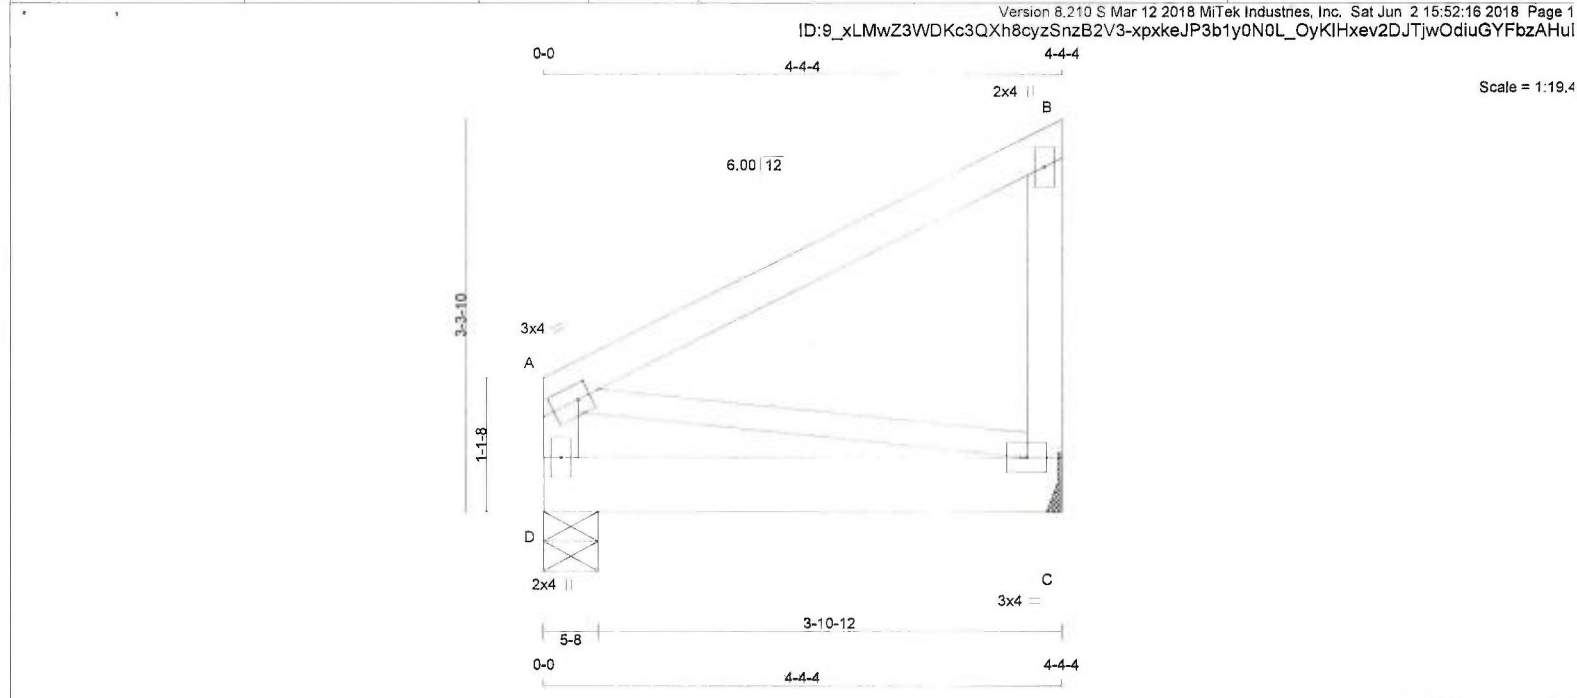

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER DESCR.
A - B 2x4 DRY No.2 SPF
C - B 2x4 DRY No.2 SPF
D - A 2x4 DRY No.2 SPF
D - C 2x6 DRY No.2 SPF
ALL WEBS 2x3 DRY No.2 SPF
DRY: SEASONED LUMBER.

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF
SPACING = 24.0 IN. C/C
GIRDER TYPE: CStdGirder
START DISTANCE = 0-0
START SPAN CARRIED = 17-0-8
END DISTANCE = 4-4-4
END SPAN CARRIED = 17-0-8
END WALL WIDTH = 5-8
APPLIED TO BACK SIDE OF BOTTOM CHORD.
- ADDTL LOADS BASED ON 55 % OF GSL.
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010
THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011
(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD
ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/586 (0.09")
CSI: TC=0.27/1.00 (A-B:1), BC=0.64/1.00 (C-D:1), WB=0.00/1.00 (A-C:1), SSI=0.53/1.00 (C-D:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS= 1.00
COMPANION LIVE LOAD FACTOR = 0.50
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.
NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656
PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.

BEARINGS
FACTORED GROSS REACTION MAXIMUM FACTORED GROSS REACTION INPUT BRG REQD BRG
JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX
C 967 0 967 0 0 5-8 5-8
D 967 0 967 0 0 5-8 5-8
A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT C TO RESIST THE MAX FACTORED REACTIONS.

PLATES (table is in inches)
JT TYPE PLATES W LEN Y X
A TMVW-t MT20 3.0 4.0 1.50 1.25
B TMV+p MT20 2.0 4.0
C BMVW1-t MT20 3.0 4.0
D BMV1+p MT20 2.0 4.0


UNFACTORED REACTIONS
1ST LCASE MAX./MIN. COMPONENT REACTIONS
JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL
C 679 471 / 0 0 / 0 0 / 0 208 / 0 0 / 0
D 679 471 / 0 0 / 0 0 / 0 208 / 0 0 / 0
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D
BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)
C H O R D S W E B S
MAX. FACTORED MAX. FACTORED MAX. FACTORED
MEMB. FORCE VERT. LOAD LC1 MAX. MAX. MEMB. MAX. FORCE MAX.
(LBS) (PLF) CSI (LC) UNBRAC LENGTH FR-TO (LBS) CSI (LC)
FR-TO FROM TO
A-B 0 / 0 -77.4 -77.4 0.27 (1) 10.00 A-C 0 / 0 0.00 (1)
C-B -168 / 0 0.0 0.0 0.03 (1) 7.81
D-A -168 / 0 0.0 0.0 0.02 (1) 7.81
D-C 0 / 0 -366.8 -366.8 0.64 (1) 10.00

JSI GRIP= 0.17 (C) (INPUT = 0.90)
JSI METAL= 0.04 (B) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



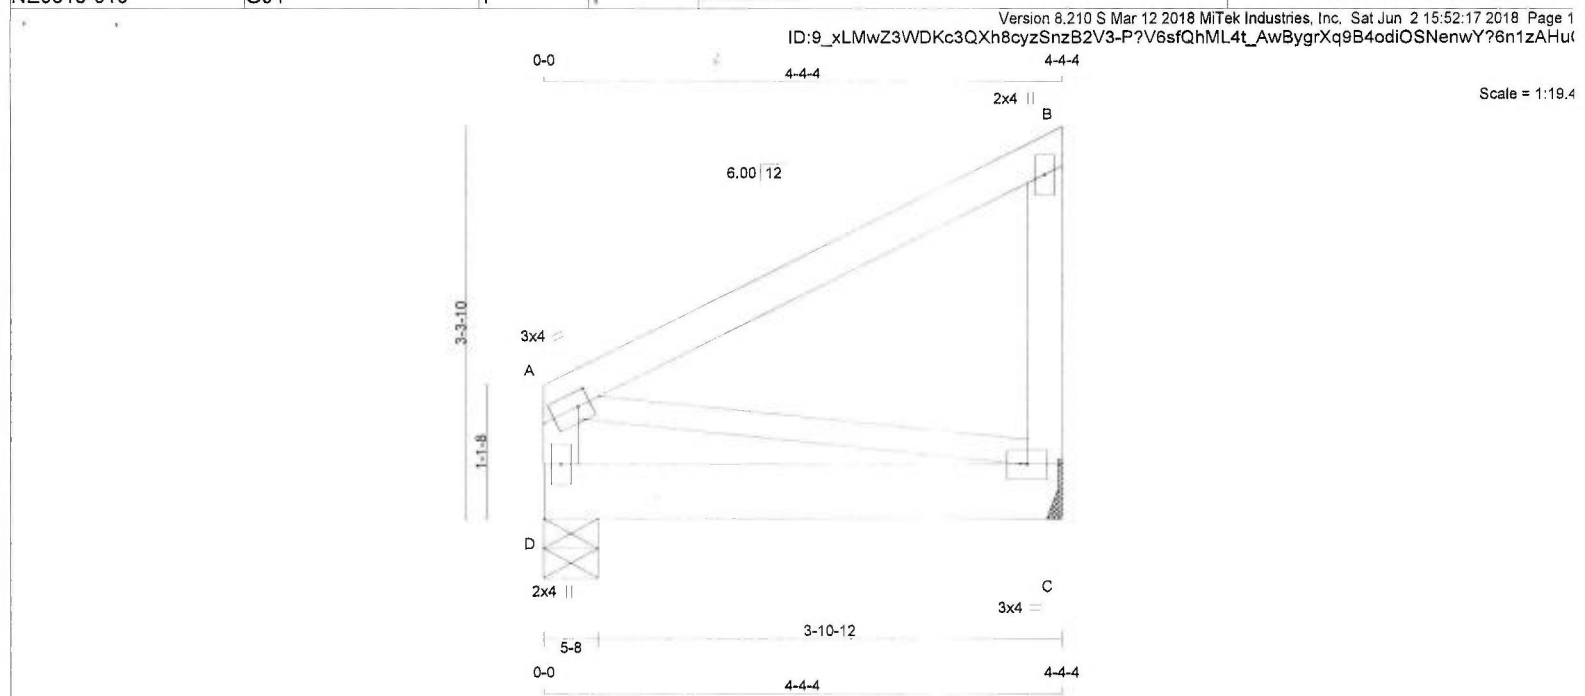


LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR.				SPF A - B 2x4 DRY No.2 C - B 2x4 DRY No.2 D - A 2x4 DRY No.2 D - C 2x6 DRY No.2				SPF ALL WEBS 2x3 DRY No.2 DRY: SEASONED LUMBER.			
PLATES (table is in inches) JT TYPE PLATES W LEN Y X				A TMVW-t MT20 3.0 4.0 1.50 1.25 B TMV+p MT20 2.0 4.0 C BMVW1-t MT20 3.0 4.0 D BMV1+p MT20 2.0 4.0							
				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 23.3 PSF DL = 3.0 PSF BOT CH. LL = 0.0 PSF DL = 7.3 PSF TOTAL LOAD = 33.6 PSF				SPACING = 24.0 IN. C/C GIRDER TYPE: CStdGirder START DISTANCE = 0-0 START SPAN CARRIED = 11-4-8 END DISTANCE = 4-4-4 END SPAN CARRIED = 11-4-8 END WALL WIDTH = 5-8 APPLIED TO FRONT SIDE OF BOTTOM CHORD. - ADDTL LOADS BASED ON 55 % OF GSL.			
				THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010 THIS DESIGN COMPLIES WITH: - PART 9 OF OBC 2012, BCBC 2012, ABC 2014 - CSA 086-09 - TPIC 2011 (55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD				ALLOWABLE DEFL.(LL)= L/360 (0.19") CALCULATED VERT. DEFL.(LL) = L/999 (0.03") ALLOWABLE DEFL.(TL)= L/360 (0.19") CALCULATED VERT. DEFL.(TL) = L/931 (0.06") CSI: TC=0.27/1.00 (A-B:1) , BC=0.40/1.00 (C-D:1) , WB=0.00/1.00 (A-C:1) , SSI=0.33/1.00 (C-D:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS= 1.00 COMPANION LIVE LOAD FACTOR = 0.50			
				TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT . NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 822 2284 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg.							

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

JSI GRIP= 0.17 (C) (INPUT = 0.90)
JSI METAL= 0.04 (B) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



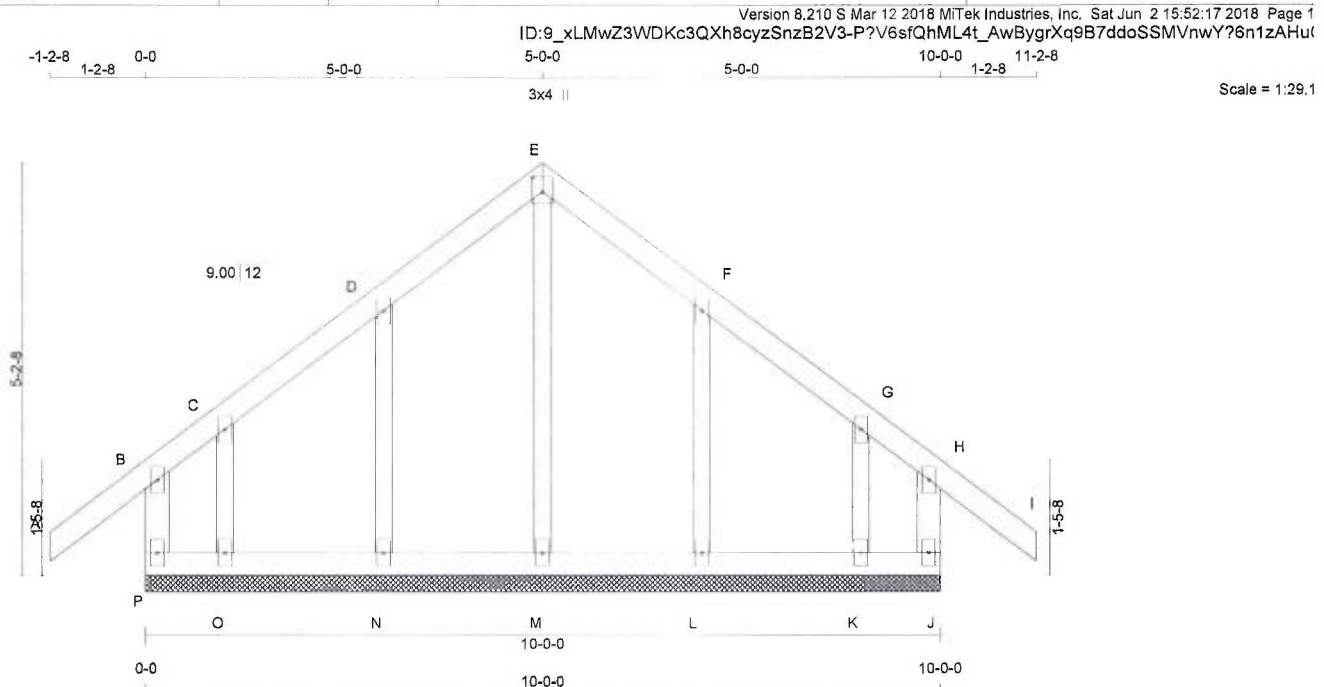

TOTAL WEIGHT = 43 lb [M]

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER DESCR.
P - B 2x4 DRY No.2 SPF
A - E 2x4 DRY No.2 SPF
E - I 2x4 DRY No.2 SPF
J - H 2x4 DRY No.2 SPF
P - J 2x4 DRY No.2 SPF

ALL WEBS 2x3 DRY No.2 SPF
ALL GABLE WEBS 2x3 DRY No.2 SPF
DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
C, D, F, G						
C	TMV+w	MT20	2.0	4.0		
E	TTW+p	MT20	3.0	4.0	2.25	1.50
H	TMV+p	MT20	2.0	4.0		
J	BMV1+p	MT20	2.0	4.0		
K, L, M, N, O						
K	BMV1+w	MT20	2.0	4.0		
P	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
P-B	-158 / 0	0.0 0.0	0.03 (1)	7.81	M-E	-189 / 0	0.07 (1)
A-B	0 / 30	-77.4 -77.4	0.09 (1)	10.00	N-D	-167 / 0	0.04 (1)
B-C	-1 / 0	-77.4 -77.4	0.06 (1)	10.00	O-C	-68 / 0	0.01 (1)
C-D	0 / 28	-77.4 -77.4	0.05 (1)	10.00	L-F	-167 / 0	0.04 (1)
D-E	0 / 26	-77.4 -77.4	0.05 (1)	10.00	K-G	-68 / 0	0.01 (1)
E-F	0 / 26	-77.4 -77.4	0.05 (1)	10.00			
F-G	0 / 28	-77.4 -77.4	0.05 (1)	10.00			
G-H	-1 / 0	-77.4 -77.4	0.06 (1)	10.00			
H-I	0 / 30	-77.4 -77.4	0.09 (1)	10.00			
J-H	-158 / 0	0.0 0.0	0.03 (1)	7.81			
P-O	-15 / 0	-18.2 -18.2	0.01 (4)	6.25			
O-N	-18 / 0	-18.2 -18.2	0.02 (4)	6.25			
N-M	-23 / 0	-18.2 -18.2	0.02 (4)	6.25			
M-L	-23 / 0	-18.2 -18.2	0.02 (4)	6.25			
L-K	-18 / 0	-18.2 -18.2	0.02 (4)	6.25			
K-J	-15 / 0	-18.2 -18.2	0.01 (4)	6.25			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.09/1.00 (H-I:1), BC=0.02/1.00 (L-M:4), WB=0.07/1.00 (E-M:1), SSI=0.06/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (E) (INPUT = 0.90)
JSI METAL= 0.06 (E) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



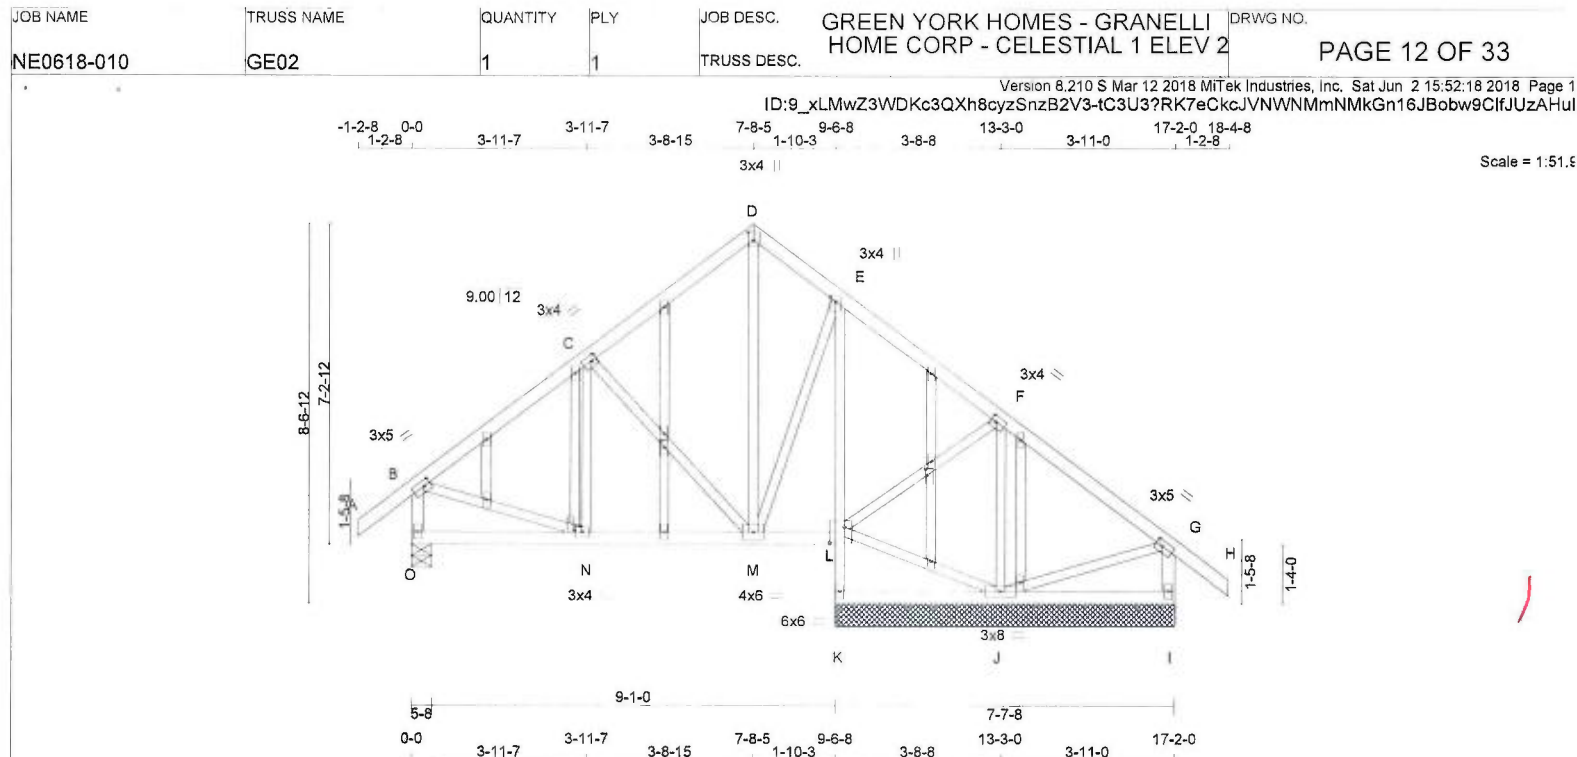

Scale = 1:51.5

TOTAL WEIGHT = 103 lb [M]

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - H	2x4	DRY	No.2	SPF
O - B	2x4	DRY	No.2	SPF
I - G	2x4	DRY	No.2	SPF
O - L	2x4	DRY	No.2	SPF
K - E	2x3	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

ALL GABLE WEBS 2x3 DRY No.2 SPF DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	3.0	5.0	1.50	1.75
C	TMVW-t	MT20	3.0	4.0	1.50	1.50
D	TTW+p	MT20	3.0	4.0	2.25	1.50
E	TMVW+p	MT20	3.0	4.0	1.50	1.50
F	TMVW-t	MT20	3.0	4.0	1.50	1.50
G	TMVW-t	MT20	3.0	5.0	1.50	1.75
I, K, O						
I	BMV1+p	MT20	2.0	4.0		
J	BMVWW1-t	MT20	3.0	8.0		
J, P, Q, R, S, T, U, V, W, X, Y						
J	NP+w	MT20	2.0	4.0		
L	BMVWW-t	MT20	6.0	6.0	4.25	4.00
M	BMVWW-t	MT20	4.0	6.0		
N	BMVWW-t	MT20	3.0	4.0		
N	NP+w	MT20	2.0	4.0	1.25	1.50
P	NP+w	MT20	2.0	4.0	1.75	1.00
X	NP+w	MT20	2.0	4.0	1.75	0.25

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	UP
O	601	0	0	5-8
K	531	0	0	7-7-8
I	326	0	0	7-7-8
J	384	0	0	7-7-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. SNOW	MAX./MIN. LIVE	MAX./MIN. PERM. LIVE	WIND	DEAD	SOIL
O	419	305 / 0	0 / 0	0 / 0	0 / 0	115 / 0	0 / 0
K	372	265 / 0	0 / 0	0 / 0	0 / 0	107 / 0	0 / 0
I	225	178 / 0	0 / 0	0 / 0	0 / 0	46 / 0	0 / 0
J	273	172 / 0	0 / 0	0 / 0	0 / 0	101 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, K, I, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	MAX. LC1 (LC)
FR-TO				FR-TO			
A-B	0 / 30	-77.4	-77.4 0.09 (1)	N-C	-16 / 63	10.00	0.02 (4)
B-C	-405 / 0	-77.4	-77.4 0.19 (1)	C-M	-265 / 0	6.25	0.15 (1)
C-D	-208 / 0	-77.4	-77.4 0.19 (1)	M-D	0 / 67	6.25	0.02 (4)
D-E	-202 / 0	-77.4	-77.4 0.07 (1)	M-E	0 / 197	6.25	0.04 (1)
E-F	-115 / 0	-77.4	-77.4 0.17 (1)	L-J	0 / 82	6.25	0.02 (1)
F-G	-75 / 0	-77.4	-77.4 0.17 (1)	L-F	0 / 12	6.25	0.00 (4)
G-H	0 / 30	-77.4	-77.4 0.09 (1)	J-F	-352 / 0	10.00	0.10 (1)
O-B	-571 / 0	0.0	0.0 0.06 (1)	B-N	0 / 354	7.81	0.08 (1)
I-G	-298 / 0	0.0	0.0 0.03 (1)	J-G	0 / 79	7.81	0.02 (1)
O-N	0 / 0	-18.2	-18.2 0.07 (4)				
N-M	0 / 341	-18.2	-18.2 0.09 (4)				
M-L	0 / 82	-18.2	-18.2 0.03 (4)				
K-L	-507 / 0	0.0	0.0 0.01 (1)				
L-E	-458 / 0	0.0	0.0 0.17 (1)				
K-J	0 / 0	-18.2	-18.2 0.08 (4)				
J-I	0 / 0	-18.2	-18.2 0.08 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.32")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.32")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.19/1.00 (B-C:1), BC=0.17/1.00 (E-L:1), WB=0.15/1.00 (C-M:1), SSI=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (F) (INPUT = 0.90)
JSI METAL= 0.17 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



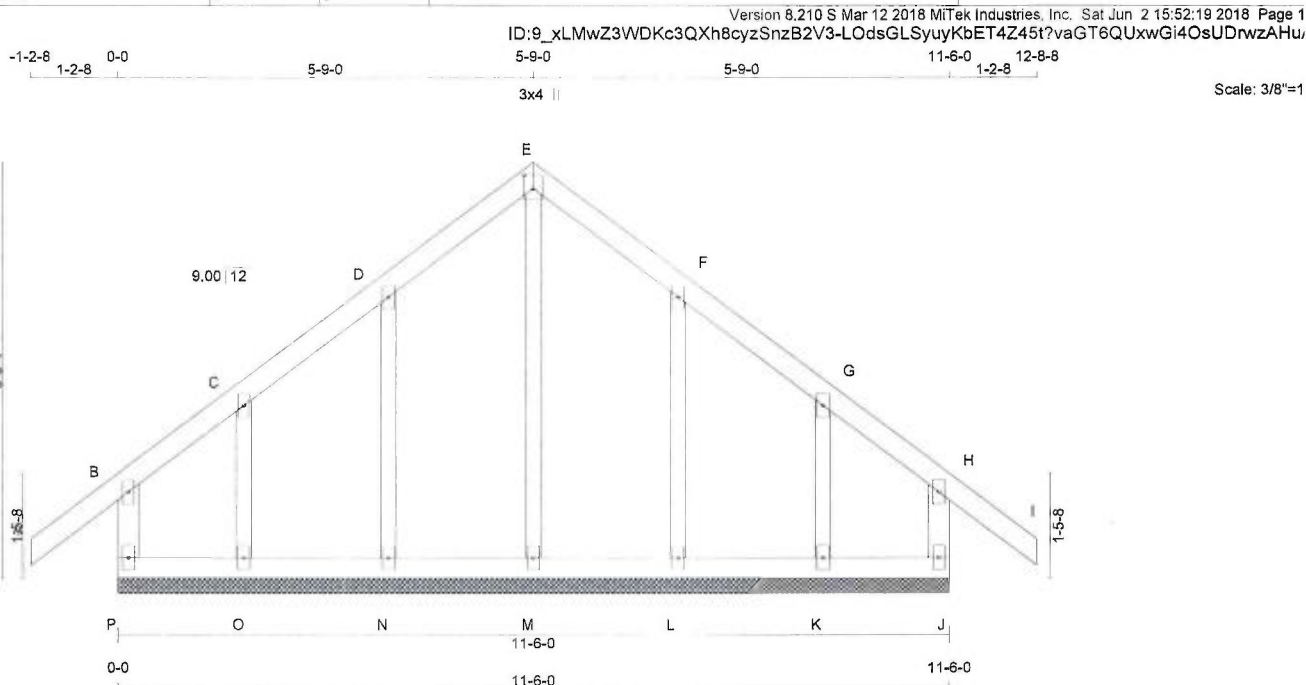

TOTAL WEIGHT = 50 lb [M]

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
P - B	2x4	DRY	No.2	SPF
A - E	2x4	DRY	No.2	SPF
E - I	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
P - J	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
ALL GABLE WEBS 2x3 DRY No.2 SPF
DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2'-0" OC.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	FACTORED CSI (LC)
FR-TO		FROM TO		FR-TO			
P-B	-172 / 0	0.0 0.0	0.03 (1)	M-E	-187 / 0	7.81	0.09 (1)
A-B	0 / 30	-77.4 -77.4	0.09 (1)	N-D	-165 / 0	10.00	0.05 (1)
B-C	-2 / 5	-77.4 -77.4	0.06 (1)	O-C	-114 / 0	10.00	0.02 (1)
C-D	0 / 25	-77.4 -77.4	0.05 (1)	L-F	-165 / 0	10.00	0.05 (1)
D-E	0 / 24	-77.4 -77.4	0.05 (1)	K-G	-114 / 0	10.00	0.02 (1)
E-F	0 / 24	-77.4 -77.4	0.05 (1)				
F-G	0 / 25	-77.4 -77.4	0.05 (1)				
G-H	-2 / 5	-77.4 -77.4	0.06 (1)				
H-I	0 / 30	-77.4 -77.4	0.09 (1)				
J-H	-172 / 0	0.0 0.0	0.03 (1)			7.81	
P-O	-13 / 0	-18.2 -18.2	0.01 (4)			6.25	
O-N	-17 / 0	-18.2 -18.2	0.01 (4)			6.25	
N-M	-21 / 0	-18.2 -18.2	0.01 (4)			6.25	
M-L	-21 / 0	-18.2 -18.2	0.01 (4)			6.25	
L-K	-17 / 0	-18.2 -18.2	0.01 (4)			6.25	
K-J	-13 / 0	-18.2 -18.2	0.01 (4)			6.25	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.09/1.00 (A-B:1), BC=0.01/1.00 (N-O:4), WB=0.09/1.00 (E-M:1), SSI=0.06/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.13 (E) (INPUT = 0.90)
JSI METAL= 0.06 (E) (INPUT = 1.00)


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
C, D, F, G						
C	TMV+w	MT20	2.0	4.0		
E	TTW+p	MT20	3.0	4.0	2.25	1.50
H	TMV+p	MT20	2.0	4.0		
J	BMV1+p	MT20	2.0	4.0		
K, L, M, N, O						
K	BMV1+w	MT20	2.0	4.0		
P	BMV1+p	MT20	2.0	4.0		



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



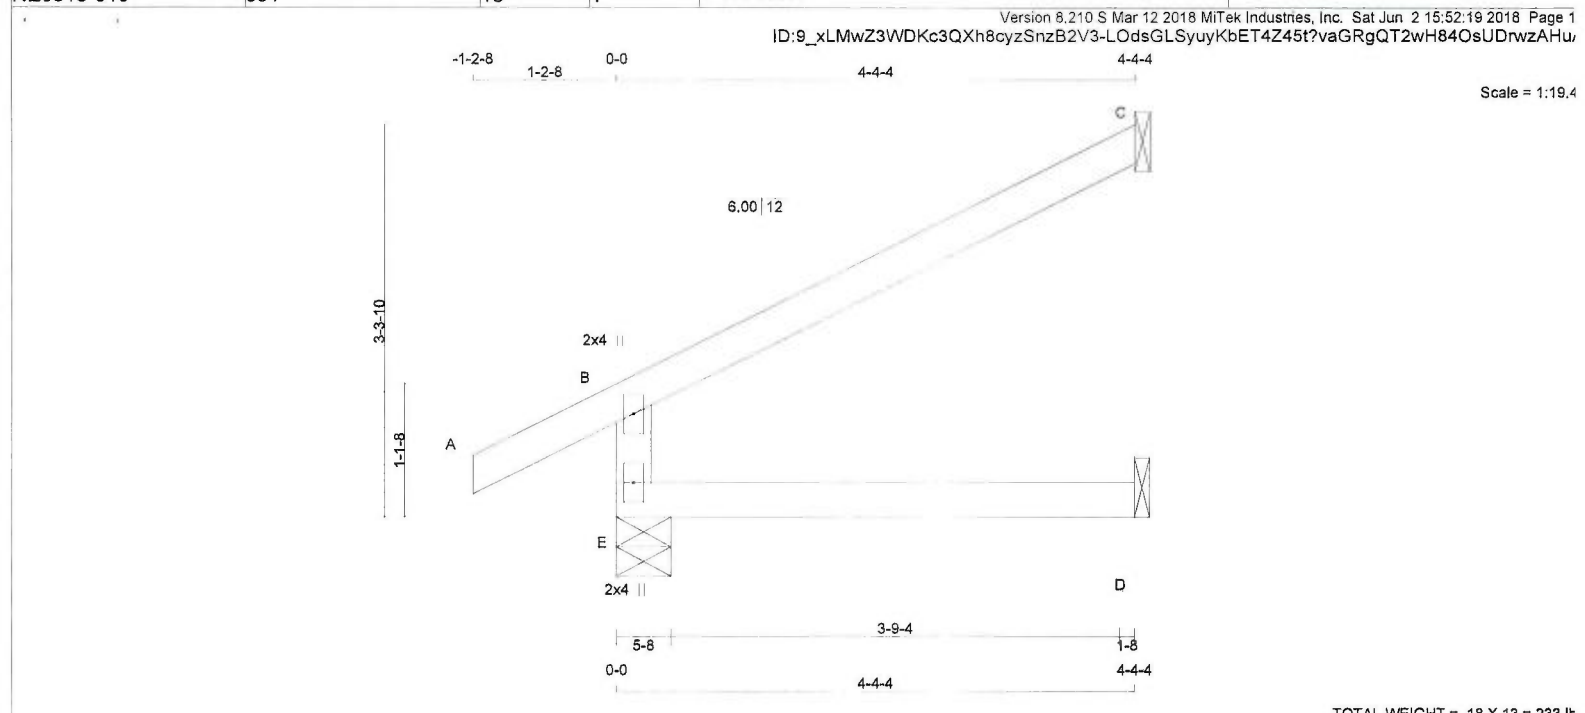

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER
E - B 2x4 DRY No.2
A - C 2x4 DRY No.2
E - D 2x4 DRY No.2

DESCR.
SPF
SPF
SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
E	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ
E	355	0	355	0
C	126	0	126	0
D	33	0	37	0

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	247	186 / 0	0 / 0	0 / 0	0 / 0	61 / 0	0 / 0
C	86	76 / 0	0 / 0	0 / 0	0 / 0	10 / 0	0 / 0
D	27	0 / 0	0 / 0	0 / 0	0 / 0	27 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (PLF)	LC1 MAX (CSI (LC))	UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED (CSI (LC))
FR-TO							FR-TO		
E-B	-309 / 0		0.0	0.0	0.06 (4)	7.81			
A-B	0 / 22		-77.4	-77.4	0.09 (1)	10.00			
B-C	-19 / 0		-77.4	-77.4	0.25 (1)	6.25			
E-D	0 / 0		-18.2	-18.2	0.07 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.25/1.00 (B-C:1), BC=0.07/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.18 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



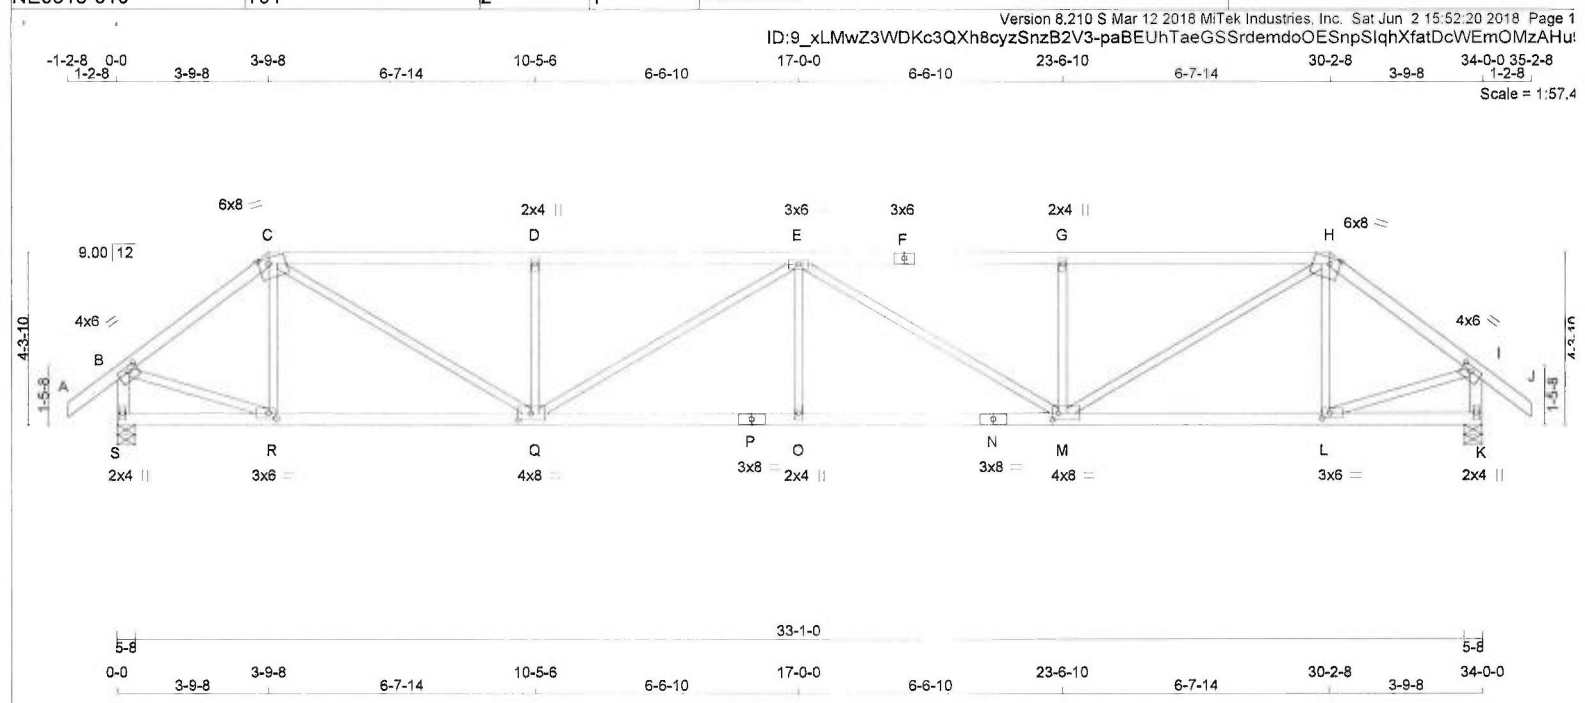

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										TOTAL WEIGHT = 2 X 131 = 262 lb	
N. L. G. A. RULES				BEARINGS											
CHORDS	SIZE	LUMBER	DESCR.	FACTORED		GROSS REACTION		MAXIMUM FACTORED		INPUT		REQRD			
A - C	2x4	DRY	No.2	SPF		JT		DOWN		BRG		BRG			
C - F	2x4	DRY	No.2	SPF		S		0		5-8		5-8			
F - H	2x4	DRY	No.2	SPF		K		0		5-8		5-8			
H - J	2x4	DRY	No.2	SPF											
S - B	2x4	DRY	No.2	SPF											
K - I	2x4	DRY	No.2	SPF											
S - P	2x4	DRY	No.2	SPF											
P - N	2x4	DRY	No.2	SPF											
N - K	2x4	DRY	No.2	SPF											
ALL WEBS 2x3 DRY No.2				SPF											
EXCEPT															

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMW-t	MT20	4.0	6.0	1.50	2.75
C	TTWW-m	MT20	6.0	8.0	1.75	3.00
D	TMW+w	MT20	2.0	4.0		
E	TMW+t	MT20	3.0	6.0		
F	TS-t	MT20	3.0	6.0		
G	TMW+w	MT20	2.0	4.0		
H	TTWW-m	MT20	6.0	8.0	1.75	3.00
I	TMW-t	MT20	4.0	6.0	1.50	2.75
K	BMV1+p	MT20	2.0	4.0		
L	BMW-t	MT20	3.0	6.0	1.50	2.25
M	BMW+t	MT20	4.0	8.0	2.00	1.75
N	BS-t	MT20	3.0	8.0		
O	BMW+w	MT20	2.0	4.0		
P	BS-t	MT20	3.0	8.0		
Q	BMW+t	MT20	4.0	8.0	2.00	3.75
R	BMW-t	MT20	3.0	6.0	1.50	2.25
S	BMV1+p	MT20	2.0	4.0		

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRAC (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 30	-77.4	-77.4 0.09 (1)	10.00	R-C	-293 / 0	0.08 (1)
B-C	-1748 / 0	-77.4	-77.4 0.25 (1)	4.80	C-Q	0 / 1916	0.43 (1)
C-D	-3030 / 0	-77.4	-77.4 0.83 (1)	3.29	Q-D	-573 / 0	0.16 (1)
D-E	-3031 / 0	-77.4	-77.4 0.82 (1)	3.29	Q-E	-565 / 0	0.67 (1)
E-F	-3031 / 0	-77.4	-77.4 0.82 (1)	3.29	Q-E	0 / 132	0.05 (4)
F-G	-3031 / 0	-77.4	-77.4 0.82 (1)	3.29	E-M	-565 / 0	0.67 (1)
G-H	-3030 / 0	-77.4	-77.4 0.83 (1)	3.29	M-G	-573 / 0	0.16 (1)
H-I	-1748 / 0	-77.4	-77.4 0.25 (1)	4.80	M-H	0 / 1916	0.43 (1)
I-J	0 / 30	-77.4	-77.4 0.09 (1)	10.00	L-H	-293 / 0	0.08 (1)
S-B	-1705 / 0	0.0	0.0 0.18 (1)	6.36	B-R	0 / 1453	0.33 (1)
K-I	-1705 / 0	0.0	0.0 0.18 (1)	6.36	L-I	0 / 1453	0.33 (1)

S-R	0 / 0	-18.2	-18.2 0.13 (4)	10.00
R-Q	0 / 1388	-18.2	-18.2 0.30 (1)	10.00
Q-P	0 / 3512	-18.2	-18.2 0.63 (1)	10.00
P-O	0 / 3512	-18.2	-18.2 0.63 (1)	10.00
O-N	0 / 3512	-18.2	-18.2 0.63 (1)	10.00
N-M	0 / 3512	-18.2	-18.2 0.63 (1)	10.00
M-L	0 / 1388	-18.2	-18.2 0.30 (1)	10.00
L-K	0 / 0	-18.2	-18.2 0.13 (4)	10.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (L) (INPUT = 0.90)

JSI METAL= 0.93 (N) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

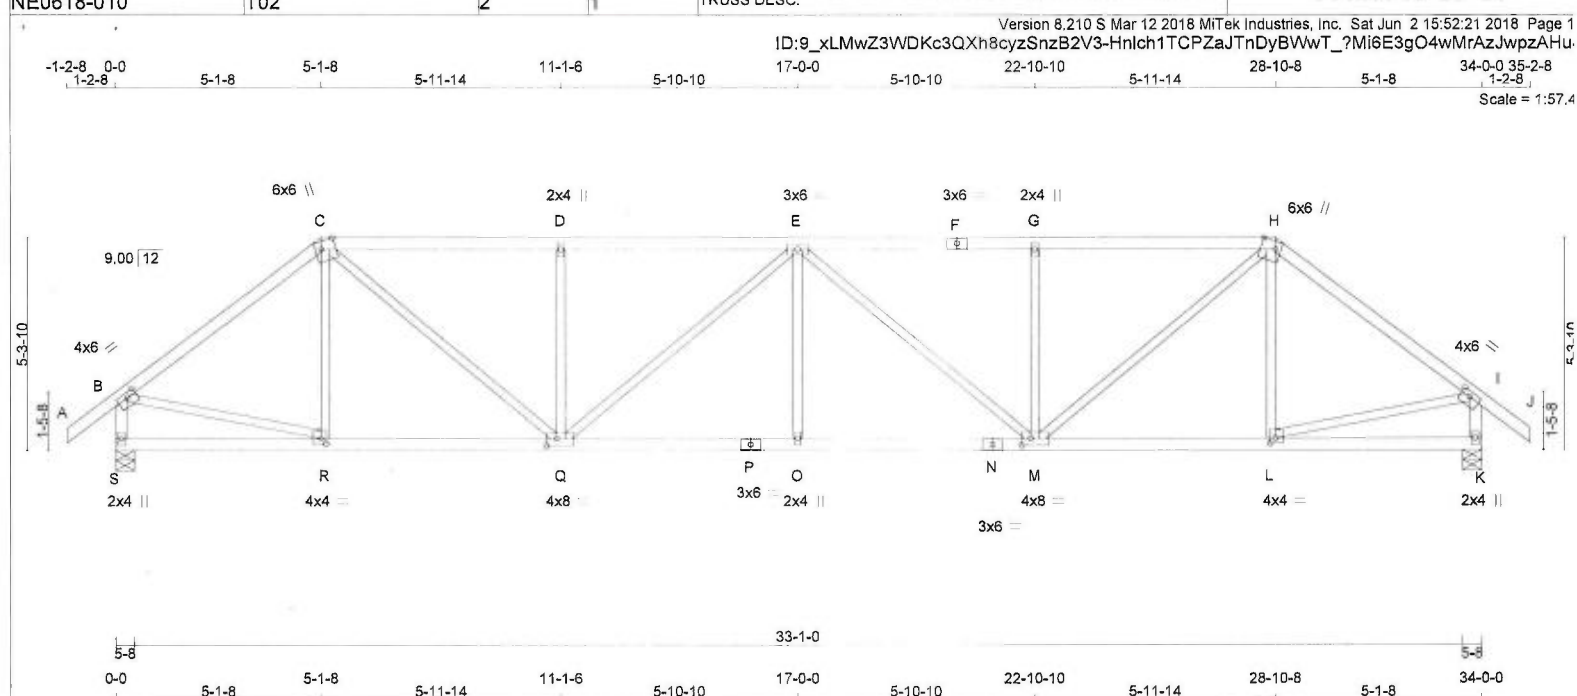

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF
C - F	2x4 DRY	No.2	SPF
F - H	2x4 DRY	No.2	SPF
H - J	2x4 DRY	No.2	SPF
S - B	2x4 DRY	No.2	SPF
K - I	2x4 DRY	No.2	SPF
S - P	2x4 DRY	No.2	SPF
P - N	2x4 DRY	No.2	SPF
N - K	2x4 DRY	No.2	SPF

ALL WEBS EXCEPT

2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
S	1726 0	1726 0	5-8	5-8
K	1726 0	1726 0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. SNOW	MAX./MIN. LIVE	MAX./MIN. PERM. LIVE	WIND	DEAD	SOIL
S	1210	852 / 0	0 / 0	0 / 0	0 / 0	358 / 0	0 / 0
K	1210	852 / 0	0 / 0	0 / 0	0 / 0	358 / 0	0 / 0

TOTAL WEIGHT = 2 X 138 = 276 lb

[M]

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.3	PSF
TOTAL LOAD	=	33.6	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.13")

CALCULATED VERT. DEFL.(LL)= L/999 (0.15")

ALLOWABLE DEFL.(TL)= L/360 (1.13")

CALCULATED VERT. DEFL.(TL)= L/999 (0.28")

CSI: TC=0.57/1.00 (C-D:1), BC=0.51/1.00 (O-Q:1), WB=0.49/1.00 (E-Q:1), SS=0.22/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (R) (INPUT = 0.90)

JSI METAL= 0.71 (P) (INPUT = 1.00)

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-t	MT20	4.0	6.0	1.50	2.75
C	TTWW+m	MT20	6.0	6.0	Edge 4.25	
D	TMW+w	MT20	2.0	4.0		
E	TMWWW-t	MT20	3.0	6.0		
F	TS-t	MT20	3.0	6.0		
G	TMW+w	MT20	2.0	4.0		
H	TTWW+m	MT20	6.0	6.0	Edge 4.25	
I	TMWV-t	MT20	4.0	6.0	1.50	2.75
K	BMV1+p	MT20	2.0	4.0		
L	BMWWW-t	MT20	4.0	4.0	1.50	1.50
M	BMWWW-t	MT20	4.0	8.0	2.00	2.50
N	BS-t	MT20	3.0	6.0		
O	BMW+w	MT20	2.0	4.0		
P	BS-t	MT20	3.0	6.0		
Q	BMWWW-t	MT20	4.0	8.0	2.00	3.00
R	BMWV-t	MT20	4.0	4.0	1.50	1.50
S	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. FACTORED UNBRAC LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRAC LENGTH (LC)	
FR-TO				FR-TO			
A-B	0 / 30	-77.4 -77.4	0.09 (1)	10.00	R-C	-195 / 32	0.08 (1)
B-C	-1795 / 0	-77.4 -77.4	0.46 (1)	4.51	C-Q	0 / 1381	0.31 (1)
C-D	-2490 / 0	-77.4 -77.4	0.57 (1)	3.83	Q-D	-515 / 0	0.22 (1)
D-E	-2490 / 0	-77.4 -77.4	0.57 (1)	3.83	Q-E	-410 / 0	0.49 (1)
E-F	-2490 / 0	-77.4 -77.4	0.57 (1)	3.83	O-E	0 / 121	0.04 (4)
F-G	-2490 / 0	-77.4 -77.4	0.57 (1)	3.83	E-M	-410 / 0	0.49 (1)
G-H	-2490 / 0	-77.4 -77.4	0.57 (1)	3.83	M-G	-515 / 0	0.22 (1)
H-I	-1795 / 0	-77.4 -77.4	0.46 (1)	4.51	M-H	0 / 1381	0.31 (1)
I-J	0 / 30	-77.4 -77.4	0.09 (1)	10.00	L-H	-195 / 32	0.08 (1)
S-B	-1689 / 0	0.0 0.0	0.18 (1)	6.39	B-R	0 / 1467	0.33 (1)
K-I	-1689 / 0	0.0 0.0	0.18 (1)	6.39	L-I	0 / 1467	0.33 (1)
S-R	0 / 0	-18.2 -18.2	0.13 (4)	10.00			
R-Q	0 / 1430	-18.2 -18.2	0.31 (1)	10.00			
Q-P	0 / 2802	-18.2 -18.2	0.51 (1)	10.00			
P-O	0 / 2802	-18.2 -18.2	0.51 (1)	10.00			
O-N	0 / 2802	-18.2 -18.2	0.51 (1)	10.00			
N-M	0 / 2802	-18.2 -18.2	0.51 (1)	10.00			
M-L	0 / 1430	-18.2 -18.2	0.31 (1)	10.00			
L-K	0 / 0	-18.2 -18.2	0.13 (4)	10.00			

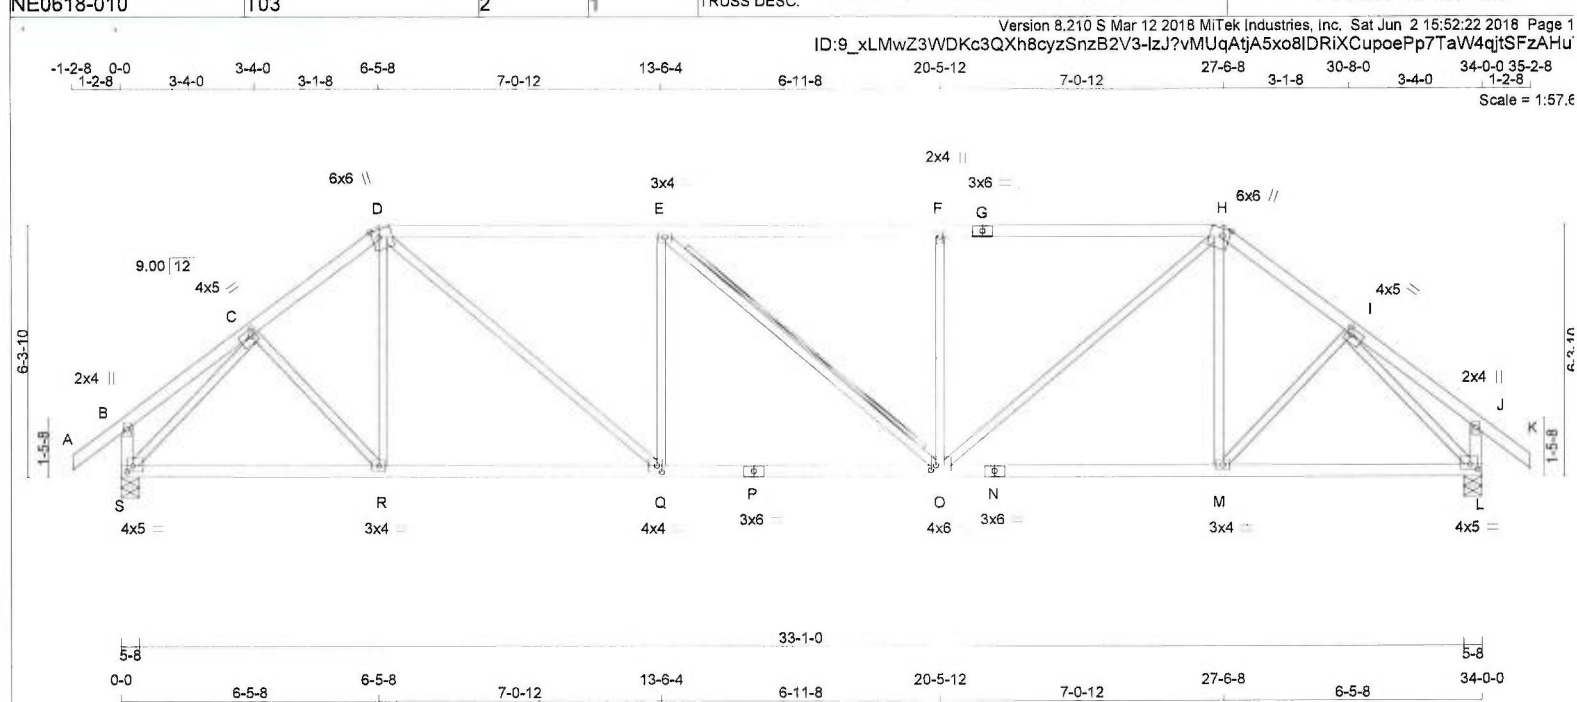

LUMBER

N. L. G. A. RULES

CHORDS

SIZE

LUMBER

DESCR.

A - D

2x4

DRY

No.2

SPF

D - G

2x4

DRY

No.2

SPF

G - H

2x4

DRY

No.2

SPF

H - K

2x4

DRY

No.2

SPF

S - B

2x4

DRY

No.2

SPF

L - J

2x4

DRY

No.2

SPF

S - P

2x4

DRY

No.2

SPF

P - N

2x4

DRY

No.2

SPF

N - L

2x4

DRY

No.2

SPF

ALL WEBS

2x3

DRY

No.2

SPF

EXCEPT

DRY: SEASONED LUMBER.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 23.3 PSF

DL = 3.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.3 PSF

TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014

- CSA 086-09

- TPIC 2011

(55% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.13")

CALCULATED VERT. DEFL.(LL) = L/999 (0.12")

ALLOWABLE DEFL.(TL)= L/360 (1.13")

CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.77/1.00 (D-E:1), BC=0.45/1.00 (O-Q:1), WB=0.72/1.00 (L-L:1), SSI=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (O) (INPUT = 0.90)

JSI METAL= 0.64 (P) (INPUT = 1.00)

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER					
BEARINGS					
JT	VERT	HORZ	FACTORED GROSS REACTION		REQRD BRG
			DOWN	HORZ	
S	1726	0	1726	0	5-8
L	1726	0	1726	0	5-8
UNFACTORED REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
S	1210	852 / 0	0 / 0	0 / 0	0 / 0
L	1210	852 / 0	0 / 0	0 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT E-O


FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW


LOADING

TOTAL LOAD CASES: (4)

CHORDS					
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED HORZ. LOAD (LC)	UNBRACED LENGTH
FR-TO					
A-B	0 / 30	-77.4	-77.4	0.09 (1)	10.00
B-C	0 / 14	-77.4	-77.4	0.11 (1)	10.00
C-D	-1811 / 0	-77.4	-77.4	0.15 (1)	4.85
D-E	-2275 / 0	-77.4	-77.4	0.77 (1)	3.75
E-F	-2273 / 0	-77.4	-77.4	0.76 (1)	3.75
F-G	-2273 / 0	-77.4	-77.4	0.76 (1)	3.77
G-H	-2273 / 0	-77.4	-77.4	0.76 (1)	3.77
H-I	-1811 / 0	-77.4	-77.4	0.15 (1)	4.85
I-J	0 / 14	-77.4	-77.4	0.11 (1)	10.00
J-K	0 / 30	-77.4	-77.4	0.09 (1)	10.00
S-B	-200 / 0	0.0	0.0	0.02 (1)	7.81
L-J	-200 / 0	0.0	0.0	0.02 (1)	7.81
S-R	0 / 1341	-18.2	-18.2	0.33 (1)	10.00
R-Q	0 / 1434	-18.2	-18.2	0.34 (1)	10.00
Q-P	0 / 2275	-18.2	-18.2	0.45 (1)	10.00
P-O	0 / 2275	-18.2	-18.2	0.45 (1)	10.00
O-N	0 / 1434	-18.2	-18.2	0.34 (1)	10.00
N-M	0 / 1434	-18.2	-18.2	0.34 (1)	10.00
M-L	0 / 1341	-18.2	-18.2	0.33 (1)	10.00
WEBS					
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORZ. LOAD (LC)	UNBRACED LENGTH		
FR-TO					
C-R	0 / 134	0.03 (1)			
R-D	0 / 94	0.03 (4)			
D-Q	0 / 1103	0.25 (1)			
Q-E	-589 / 0	0.37 (1)			
E-O	-2 / 0	0.00 (1)			
O-F	-587 / 0	0.37 (1)			
O-H	0 / 1100	0.25 (1)			
M-H	0 / 94	0.03 (4)			
M-I	0 / 134	0.03 (1)			
S-C	-1995 / 0	0.72 (1)			
I-L	-1996 / 0	0.72 (1)			




JSI GRIP= 0.90 (S) (INPUT = 0.90)
JSI METAL= 0.60 (C) (INPUT = 1.00)

 $\overline{M}[F$

JSI GRIP= 0.88 (J) (INPUT = 0.90)
JSI METAL= 0.49 (B) (INPUT = 1.00)



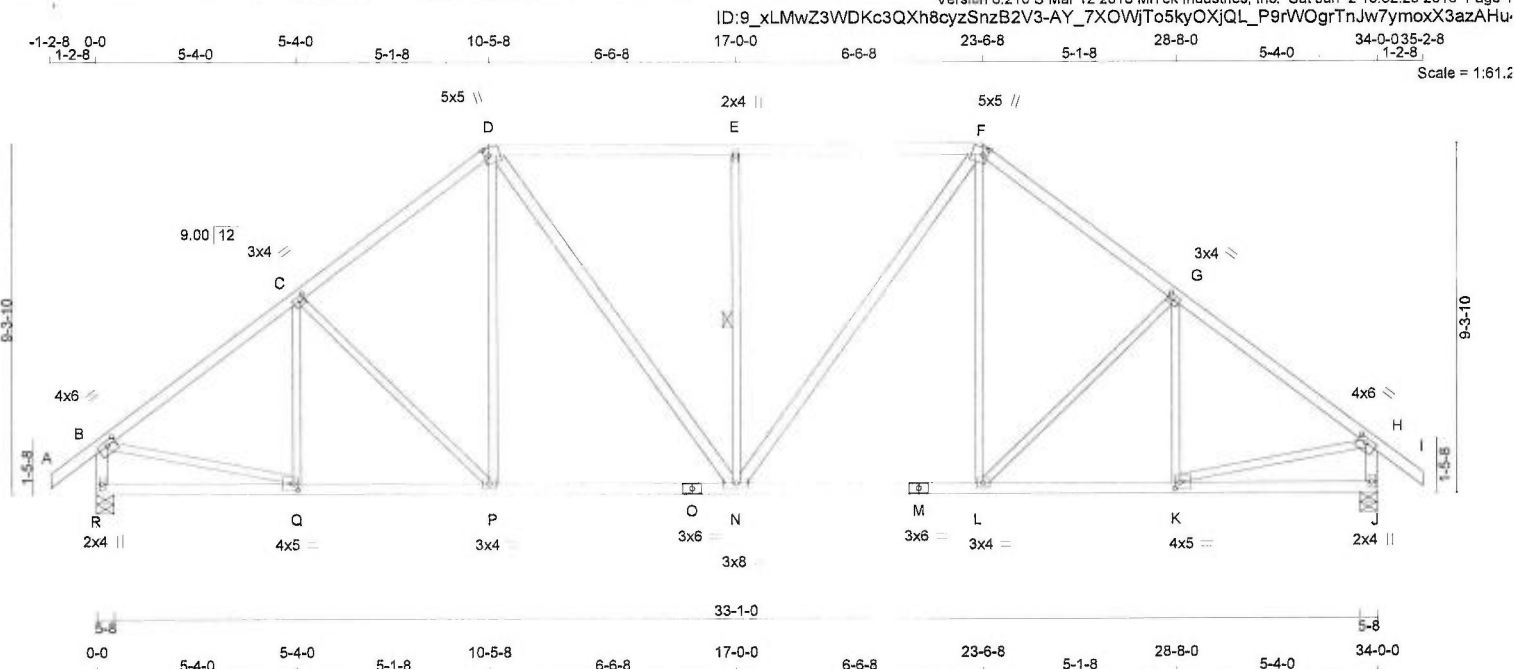

TOTAL WEIGHT = 2 X 163 = 326 lb [M]F

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
R - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
R - O	2x4	DRY	No.2	SPF
O - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
D - N	2x4	DRY	No.2	SPF
N - F	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	6.0	1.50	2.75
C	TMVW-t	MT20	3.0	4.0	1.50	1.50
D	TTWw+m	MT20	5.0	5.0	2.25	1.50
E	TMVW-t	MT20	2.0	4.0		
F	TTWw+m	MT20	5.0	5.0	2.25	1.50
G	TMVW-t	MT20	3.0	4.0	1.50	1.50
H	TMVW-t	MT20	4.0	6.0	1.50	2.75
J	BMV1+p	MT20	2.0	4.0		
K	BMVW-t	MT20	4.0	5.0	2.00	1.50
L	BMVW-t	MT20	3.0	4.0		
M	BS-4	MT20	3.0	6.0		
N	BMVW-t	MT20	3.0	6.0		
O	BS-4	MT20	3.0	6.0		
P	BMVW-t	MT20	3.0	4.0		
Q	BMVW-t	MT20	4.0	5.0	2.00	1.50
R	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQRD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
R	1726	0	1726	0	5-8	5-8
J	1726	0	1726	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
R	1210	852 / 0	0 / 0	0 / 0	0 / 0	358 / 0	0 / 0
J	1210	852 / 0	0 / 0	0 / 0	0 / 0	358 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.65 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 - 1x4 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N. DBS = 20-0-0, CBF = 78 LBS.

DBS = DIAGONAL BRACE SPACING (MAX). CBF = CUMULATIVE BRACING FORCE (PER BRACE). FASTEN LATERAL BRACE(S) USING (0.122"x3") SPIRAL NAILS: 1 NAIL FOR 2x3 BRACE(S), 2 FOR 1x4, 2x4, 2x5, 3 FOR 2x6, 4 FOR 2x8, 5 FOR 2x10, AND 6 FOR 2x12.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 / 30	-77.4 -77.4	0.09 (1)	10.00	Q-C	-213 / 23	0.10 (1)
B-C	-1823 / 0	-77.4 -77.4	0.34 (1)	4.65	C-P	-237 / 0	0.25 (1)
C-D	-1672 / 0	-77.4 -77.4	0.32 (1)	4.83	P-D	0 / 273	0.06 (1)
D-E	-1585 / 0	-77.4 -77.4	0.47 (1)	4.70	D-N	0 / 459	0.07 (1)
E-F	-1585 / 0	-77.4 -77.4	0.47 (1)	4.70	N-E	-620 / 0	0.35 (1)
F-G	-1672 / 0	-77.4 -77.4	0.32 (1)	4.83	N-F	0 / 459	0.07 (1)
G-H	-1823 / 0	-77.4 -77.4	0.34 (1)	4.65	L-F	0 / 273	0.06 (1)
H-I	0 / 30	-77.4 -77.4	0.09 (1)	10.00	L-G	-237 / 0	0.25 (1)
R-B	-1684 / 0	0.0 0.0	0.17 (1)	6.40	K-G	-213 / 23	0.10 (1)
J-H	-1684 / 0	0.0 0.0	0.17 (1)	6.40	B-Q	0 / 1514	0.34 (1)
R-Q	0 / 0	-18.2 -18.2	0.11 (4)	10.00	K-H	0 / 1514	0.34 (1)
Q-P	0 / 1481	-18.2 -18.2	0.31 (1)	10.00			
P-O	0 / 1315	-18.2 -18.2	0.30 (1)	10.00			
O-N	0 / 1315	-18.2 -18.2	0.30 (1)	10.00			
N-M	0 / 1315	-18.2 -18.2	0.30 (1)	10.00			
M-L	0 / 1315	-18.2 -18.2	0.30 (1)	10.00			
L-K	0 / 1481	-18.2 -18.2	0.31 (1)	10.00			
K-J	0 / 0	-18.2 -18.2	0.11 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.3	PSF
TOTAL LOAD		=	33.6	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.13")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (1.13")
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.47/1.00 (D-E:1), BC=0.31/1.00 (P-Q:1), WB=0.35/1.00 (E-N:1), SSI=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (J) (INPUT = 0.90)
JSI METAL= 0.50 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



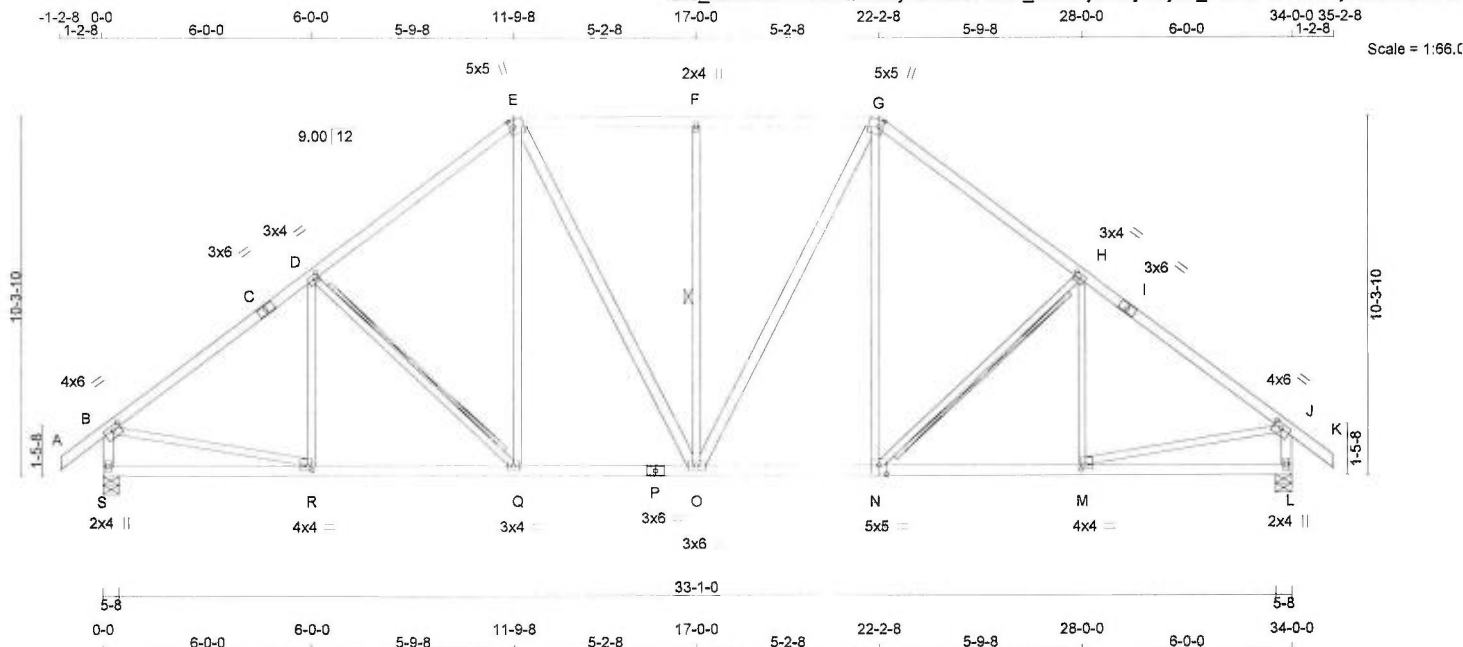

Scale = 1/64.0

TOTAL WEIGHT = 2 X 170 = 340 lb [M]F

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
I - K	2x4	DRY	No.2	SPF
S - B	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
S - P	2x4	DRY	No.2	SPF
P - N	2x4	DRY	No.2	SPF
N - L	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
E - O	2x4	DRY	No.2	SPF
O - G	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	6.0	1.50	2.75
C	TS-t	MT20	3.0	6.0		
D	TMVW-t	MT20	3.0	4.0	1.50	1.50
E	TTWW+m	MT20	5.0	5.0	2.25	1.50
F	TMVW+w	MT20	2.0	4.0		
G	TTWW+m	MT20	5.0	5.0	2.25	1.50
H	TMVW-t	MT20	3.0	4.0	1.50	1.50
I	TS-t	MT20	3.0	6.0		
J	TMVW-t	MT20	4.0	6.0	1.50	2.75
L	BMV1+p	MT20	2.0	4.0		
M	BMVW-t	MT20	4.0	4.0	1.50	1.50
N	BSVW-t	MT20	5.0	5.0	3.00	2.50
O	BMVWV-t	MT20	3.0	6.0		
P	BS-t	MT20	3.0	6.0		
Q	BMVW-t	MT20	3.0	4.0		
R	BMVW-t	MT20	4.0	4.0	1.50	1.50
S	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
S	1726	0	1726	0
L	1726	0	1726	0

UNFACTORED REACTIONS

JT	1ST CASE	MAX./MIN.	COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1210	852 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	358 / 0	0 / 0
L	1210	852 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	358 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.52 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 - 1x4 LATERAL BRACE(S) AT 1/2 LENGTH OF F-O. DBS = 20'-0-0. CBF = 61 LBS. 2x4 DRY SPF No.2 T-BRACE AT D-Q, H-N

DBS = DIAGONAL BRACE SPACING (MAX). CBF = CUMULATIVE BRACING FORCE (PER BRACE). FASTEN LATERAL BRACE(S) USING (0.122"x3") SPIRAL NAILS: 1 NAIL FOR 2x3 BRACE(S), 2 FOR 1x4, 2x4, 2x5, 3 FOR 2x6, 4 FOR 2x8, 5 FOR 2x10, AND 6 FOR 2x12.

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORZ. LOAD (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORZ. LOAD (LC)
FR-TO		FROM TO	CSI (LC)	FR-TO		FROM TO	CSI (LC)
A-B	0 / 30	-77.4	-77.4 0.09 (1)	10.00	R-D	-161 / 54	0.09 (1)
B-C	-1835 / 0	-77.4	-77.4 0.44 (1)	4.52	D-Q	-332 / 0	0.17 (1)
C-D	-1835 / 0	-77.4	-77.4 0.44 (1)	4.52	Q-E	0 / 328	0.07 (1)
D-E	-1604 / 0	-77.4	-77.4 0.44 (1)	4.80	E-O	0 / 327	0.05 (1)
E-F	-1409 / 0	-77.4	-77.4 0.29 (1)	5.18	O-F	-499 / 0	0.36 (1)
F-G	-1409 / 0	-77.4	-77.4 0.29 (1)	5.18	O-G	0 / 327	0.05 (1)
G-H	-1604 / 0	-77.4	-77.4 0.40 (1)	4.80	N-G	0 / 328	0.07 (1)
H-I	-1835 / 0	-77.4	-77.4 0.44 (1)	4.52	N-H	-332 / 0	0.17 (1)
I-J	-1835 / 0	-77.4	-77.4 0.44 (1)	4.52	M-H	-161 / 54	0.09 (1)
J-K	0 / 30	-77.4	-77.4 0.09 (1)	10.00	B-R	0 / 1520	0.34 (1)
S-B	-1680 / 0	0.0	0.0 0.17 (1)	6.41	M-J	0 / 1520	0.34 (1)
L-J	-1680 / 0	0.0	0.0 0.17 (1)	6.41			
S-R	0 / 0	-18.2	-18.2 0.16 (4)	10.00			
R-Q	0 / 1494	-18.2	-18.2 0.32 (1)	10.00			
Q-P	0 / 1258	-18.2	-18.2 0.26 (1)	10.00			
P-O	0 / 1258	-18.2	-18.2 0.26 (1)	10.00			
O-N	0 / 1258	-18.2	-18.2 0.26 (1)	10.00			
N-M	0 / 1494	-18.2	-18.2 0.32 (1)	10.00			
M-L	0 / 0	-18.2	-18.2 0.16 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	23.3 PSF
DL	=	3.0 PSF
BOT CH. LL	=	0.0 PSF
DL	=	7.3 PSF
TOTAL LOAD	=	33.6 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.13")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (1.13")
CALCULATED VERT. DEFL.(TL) = L/999 (0.13")

CSI: TC=0.44/1.00 (B-D:1), BC=0.32/1.00 (M-N:1), WB=0.36/1.00 (F-O:1), SSI=0.19/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.90 (M) (INPUT = 0.90)
JSI METAL= 0.56 (M) (INPUT = 1.00)



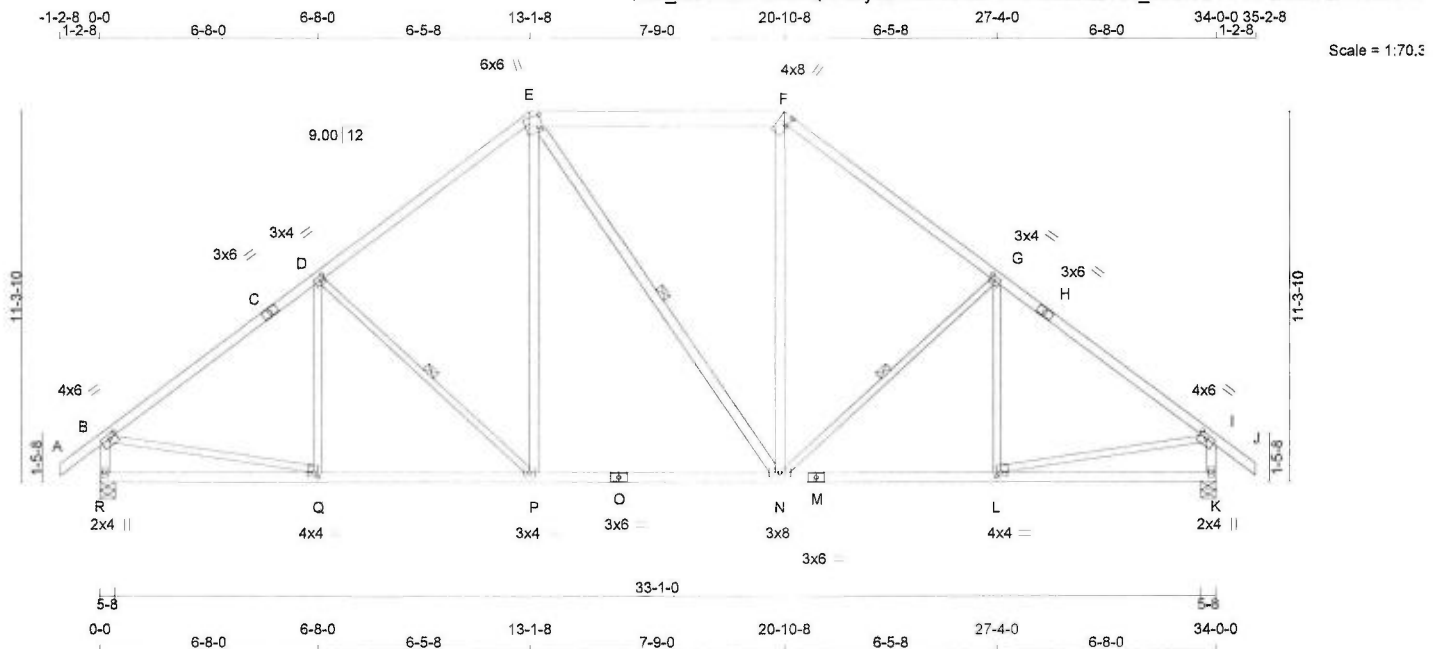

TOTAL WEIGHT = $3 \times 169 = 507 \text{ lb}$
[M][F]

LUMBER		N. L. G. A. RULES		LUMBER		DESCR	
CHORDS	SIZE						
A - C	2x4	DRY	No.2		SPF		
C - E	2x4	DRY	No.2		SPF		
E - F	2x6	DRY	No.2		SPF		
F - H	2x4	DRY	No.2		SPF		
H - J	2x4	DRY	No.2		SPF		
R - B	2x4	DRY	No.2		SPF		
K - I	2x4	DRY	No.2		SPF		
R - O	2x4	DRY	No.2		SPF		
O - M	2x4	DRY	No.2		SPF		
M - K	2x4	DRY	No.2		SPF		
ALL WEBS EXCEPT	2x3	DRY	No.2		SPF		
P - E	2x4	DRY	No.2		SPF		
E - N	2x4	DRY	No.2		SPF		
N - F	2x4	DRY	No.2		SPF		

DRY: SEASONED LUMBER.

PLATES (table is in inches)						
J	T	TYPE	PLATES	W	LEN	Y X
B	TMVV-t		MT20	4.0	6.0	1.50 2.75
C	TS-t		MT20	3.0	6.0	
D	TMVV-t		MT20	3.0	4.0	1.50 1.50
E	TTVV+m		MT20	6.0	6.0	4.25 1.25
F	TTW-t		MT20	4.0	8.0	Edge 1.50
G	TMVV-t		MT20	3.0	4.0	1.50 1.50
H	TS-t		MT20	3.0	6.0	
I	TMVV-t		MT20	4.0	6.0	1.50 2.75
K	BMV1+p		MT20	2.0	4.0	
L	BMVV-t		MT20	4.0	4.0	1.50 1.50
M	BS-t		MT20	3.0	6.0	
N	BMVVVV-t		MT20	3.0	8.0	
O	BS-t		MT20	3.0	6.0	
P	BMVV-t		MT20	3.0	4.0	
Q	BMVV-t		MT20	4.0	4.0	1.50 1.50
R	BMV1+p		MT20	2.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
R	1726	0	1726	0	0	5-8	5-8
K	1726	0	1726	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	1210	852 / 0	0 / 0	0 / 0	0 / 0	358 / 0	0 / 0
K	1210	852 / 0	0 / 0	0 / 0	0 / 0	358 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.38 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 - 1x4 LATERAL BRACE(S) AT 1/2 LENGTH OF D-P, E-N, G-N. DBS = 20-0-0 . CBF = 51 LBS.

DBS = DIAGONAL BRACE SPACING (MAX), CBF = CUMULATIVE BRACING FORCE (PER BRACE), FASTEN LATERAL BRACE(S) USING (0.122"x3") SPIRAL NAILS : 1 NAIL FOR 2x3 BRACE(S), 2 FOR 1x4, 2x4, 2x5, 3 FOR 2x6, 4 FOR 2x8, 5 FOR 2x10, AND 6 FOR 2x12.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED (LBS)	FACTORED VERT. LOAD (PLF)	MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM	TO		FR-TO			
A-B	0/30	-77.4	-77.4	0.09 (1)	10.00	Q-D	-123 / 73	0.08 (1)
B-C	-1837 / 0	-77.4	-77.4	0.56 (1)	4.38	D-P	-409 / 0	0.23 (1)
C-D	-1837 / 0	-77.4	-77.4	0.56 (1)	4.38	P-E	0 / 407	0.07 (1)
D-E	-1533 / 0	-77.4	-77.4	0.51 (1)	4.75	E-N	0 / 0	0.00 (1)
E-F	-1204 / 0	-77.4	-77.4	0.30 (1)	6.25	N-F	0 / 408	0.07 (1)
F-G	-1533 / 0	-77.4	-77.4	0.51 (1)	4.75	N-G	-409 / 0	0.23 (1)
G-H	-1836 / 0	-77.4	-77.4	0.56 (1)	4.38	L-G	-124 / 73	0.08 (1)
H-I	-1836 / 0	-77.4	-77.4	0.56 (1)	4.38	B-Q	0 / 1520	0.34 (1)
I-J	0/30	-77.4	-77.4	0.09 (1)	10.00	L-I	0 / 1520	0.34 (1)
R-B	-1675 / 0	0.0	0.0	0.17 (1)	6.41			
K-I	-1675 / 0	0.0	0.0	0.17 (1)	6.41			
R-Q	0/0	-18.2	-18.2	0.18 (4)	10.00			
Q-P	0/1498	-18.2	-18.2	0.34 (1)	10.00			
P-O	0/1204	-18.2	-18.2	0.30 (1)	10.00			
O-N	0/1204	-18.2	-18.2	0.30 (1)	10.00			
N-M	0/1498	-18.2	-18.2	0.35 (1)	10.00			
M-L	0/1498	-18.2	-18.2	0.35 (1)	10.00			
L-K	0/0	-18.2	-18.2	0.18 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.3	PSF
TOTAL LOAD	=	33.6	PSF

TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A
SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.13")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.07")
ALLOWABLE DEFL.(TL)= L/360 (1.13")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.15")

CSI: TC=0.56/1.00 (B-D:1), BC=0.35/1.00 (L-N:1),
WB=0.34/1.00 (B-Q:1), SS=0.20/1.00 (B-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)		SHEAR		SECTION
	(PSI)		(PLI)		(PLI)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	618	354	1667	822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.88 (Q) (INPUT = 0.90)
JSI METAL= 0.56 (Q) (INPUT = 1.00)

CONTINUED ON PAGE 2



READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



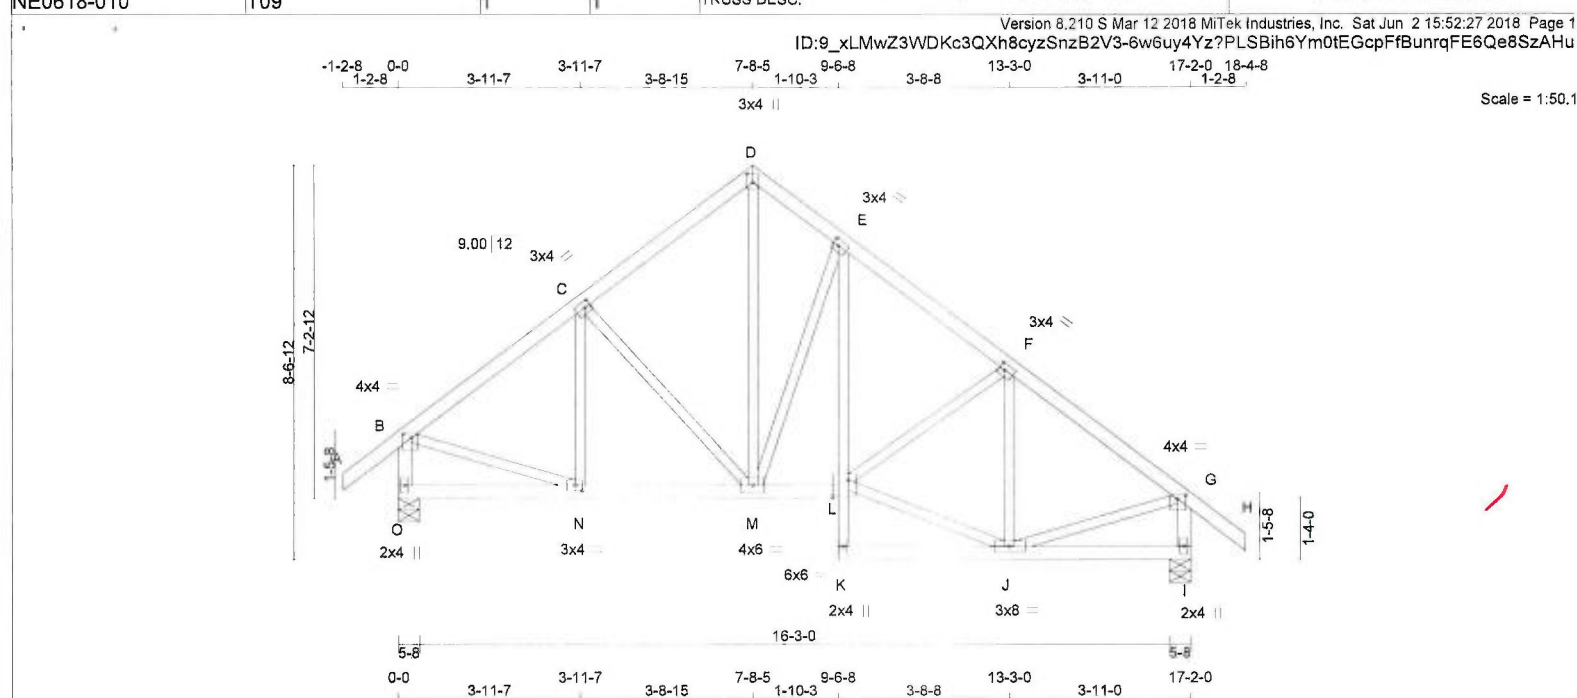

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										TOTAL WEIGHT = 88 lb		
N. L. G. A. RULES				BEARINGS										[M][F]		
CHORDS	SIZE	LUMBER	DESCR.											DESIGN CRITERIA		
A - D	2x4	DRY	No.2	SPF	FACTORED		MAXIMUM FACTORED		INPUT		REQRD		SPECIFIED LOADS:			
D - H	2x4	DRY	No.2	SPF	GROSS REACTION		GROSS REACTION		BRG		BRG		TOP CH. LL = 23.3 PSF			
O - B	2x4	DRY	No.2	SPF	JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	DL = 3.0 PSF			
I - G	2x4	DRY	No.2	SPF	O	921	0	921	0	0	5-8	5-8	BOT CH. LL = 0.0 PSF			
O - L	2x4	DRY	No.2	SPF	I	921	0	921	0	0	5-8	5-8	DL = 7.3 PSF			
K - E	2x3	DRY	No.2	SPF											TOTAL LOAD = 33.6 PSF	
K - I	2x4	DRY	No.2	SPF											SPACING = 24.0 IN./C/C	
ALL WEBS	2x3	DRY	No.2	SPF	UNFACTORED REACTIONS										THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010	
EXCEPT					1ST LCASE MAX./MIN. COMPONENT REACTIONS										THIS DESIGN COMPLIES WITH: - PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014 - CSA 086-09 - TPIC 2011	
DRY: SEASONED LUMBER.					JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	ALLOWABLE DEFL.(LL)= L/360 (0.57") CALCULATED VERT. DEFL.(LL) = L/ 999 (0.03") ALLOWABLE DEFL.(TL)= L/360 (0.57") CALCULATED VERT. DEFL.(TL) = L/ 999 (0.05")			
					O	845	460 / 0	0 / 0	0 / 0	0 / 0	185 / 0	0 / 0	CSI: TC=0.15/1.00 (B-C:1) , BC=0.14/1.00 (L-M:1) , WB=0.28/1.00 (E-M:1) , SS=0.12/1.00 (B-C:1)			
					I	845	460 / 0	0 / 0	0 / 0	0 / 0	185 / 0	0 / 0	DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10			
					BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, I										COMPANION LIVE LOAD FACTOR = 0.50	
					BRACING										TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .	
					TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.										NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 822 2284 1666	
					ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.											
					LOADING											
					TOTAL LOAD CASES: (4)											
					CHORDS											
					MEMB. MAX. FACTORED FORCE (LBS)											
					FACTORED VERT. LOAD (PLF)											
					CS1 (LC)											
					UNBRAC LENGTH											
					FR-TO											
					A-B											
					B-C											
					C-D											
					D-E											
					E-F											
					F-G											
					G-H											
					O-B											
					I-G											
					O-N											
					N-M											
					M-L											
					K-L											
					L-E											

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 23.3 PSF

DL = 3.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.3 PSF

TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014

- CSA 086-09

- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.57")

CALCULATED VERT. DEFL.(LL) = L/ 999 (0.03")

ALLOWABLE DEFL.(TL)= L/360 (0.57")

CALCULATED VERT. DEFL.(TL) = L/ 999 (0.05")

CSI: TC=0.15/1.00 (B-C:1) , BC=0.14/1.00 (L-M:1) , WB=0.28/1.00 (E-M:1) , SSI=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (N) (INPUT = 0.90)

JSI METAL= 0.24 (N) (INPUT = 1.00)

LICENSED PROFESSIONAL ENGINEER


N.A. EL-MASRI

APPROVED FOR CONSTRUCTION

Jun 02, 2018

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

KOTT

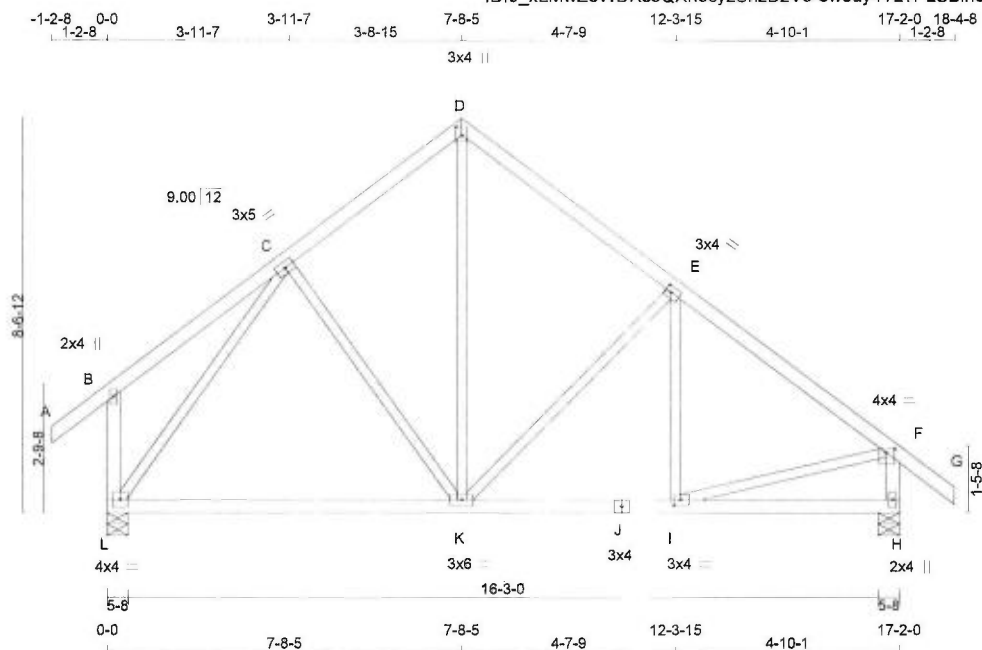

Scale = 1:50.1

TOTAL WEIGHT = 81 lb [M]F

LUMBER

N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
L - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
C	TMVW-t	MT20	3.0	5.0		
D	TTW+p	MT20	3.0	4.0	2.25	1.50
E	TMVW-t	MT20	3.0	4.0	1.50	1.50
F	TMVW-p	MT20	4.0	4.0	1.00	2.25
H	BMV1+p	MT20	2.0	4.0		
I	BMVW-t	MT20	3.0	4.0	1.50	1.75
J	BS-t	MT20	3.0	4.0		
K	BMVW-t	MT20	3.0	6.0		
L	BMVW1-t	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	HORZ	IN-SX	IN-SX
L	921	0	5-8	5-8
H	921	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE	
L	645	460 / 0	0 / 0	0 / 0	185 / 0
H	645	460 / 0	0 / 0	0 / 0	185 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 30	-77.4 -77.4	0.09 (1)	10.00	C-K	-55 / 31	0.04 (1)
B-C	0 / 21	-77.4 -77.4	0.18 (1)	10.00	K-D	0 / 404	0.09 (1)
C-D	-564 / 0	-77.4 -77.4	0.14 (1)	6.25	K-E	-305 / 0	0.25 (1)
D-E	-570 / 0	-77.4 -77.4	0.22 (1)	6.25	I-E	-77 / 41	0.03 (1)
E-F	-783 / 0	-77.4 -77.4	0.23 (1)	6.25	L-C	-798 / 0	0.61 (1)
F-G	0 / 30	-77.4 -77.4	0.09 (1)	10.00	I-F	0 / 665	0.15 (1)
L-B	-215 / 0	0.0 0.0	0.03 (1)	7.81			
H-F	-881 / 0	0.0 0.0	0.09 (1)	7.81			
L-K	0 / 467	-18.2 -18.2	0.26 (4)	10.00			
K-J	0 / 647	-18.2 -18.2	0.27 (4)	10.00			
J-I	0 / 647	-18.2 -18.2	0.27 (4)	10.00			
I-H	0 / 0	-18.2 -18.2	0.10 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.57")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.57")
CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CSI: TC=0.23/1.00 (E-F:1), BC=0.27/1.00 (I-K:4), WB=0.61/1.00 (C-L:1), SSI=0.14/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (I) (INPUT = 0.90)
JSI METAL= 0.25 (F) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



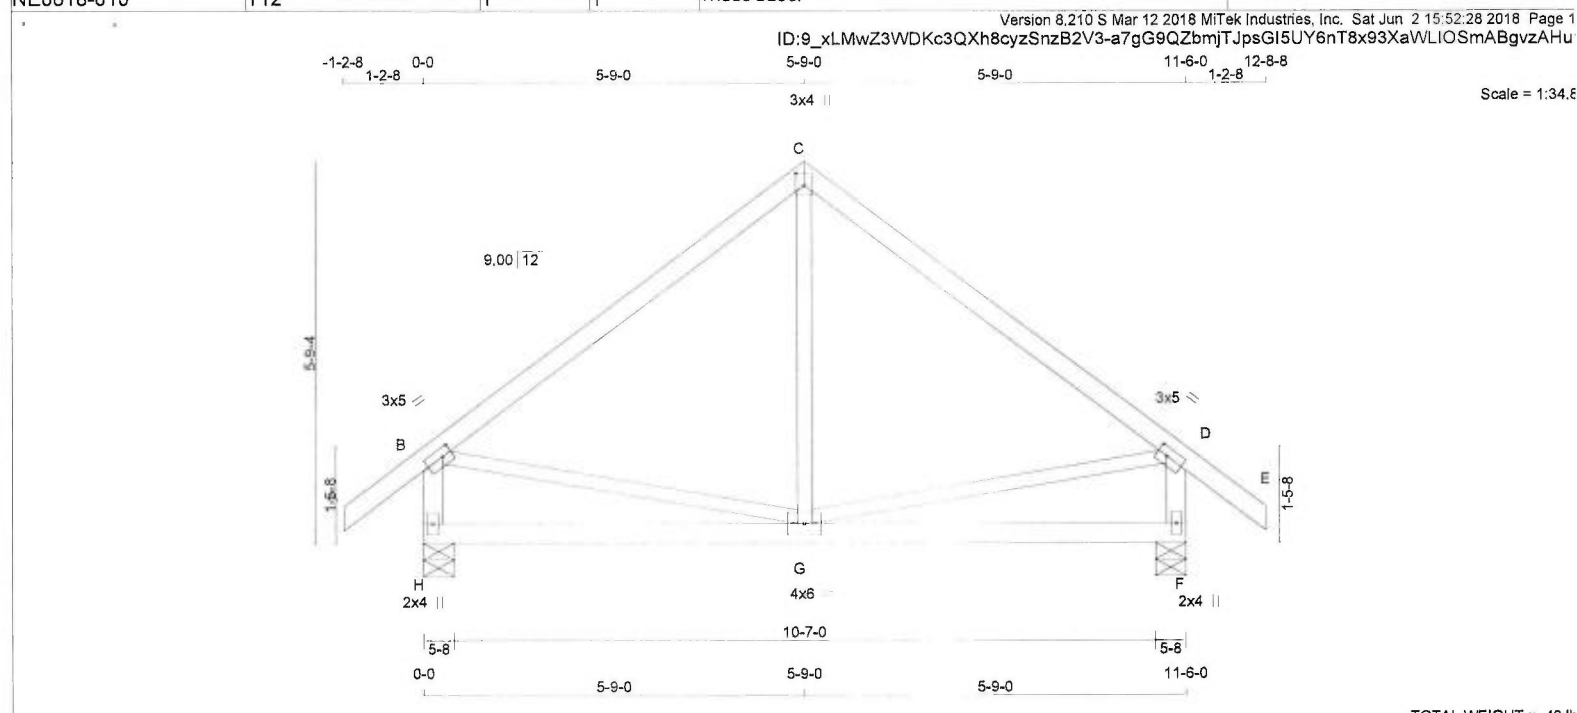

TOTAL WEIGHT = 49 lb [M]/F

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
H - B	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	3.0	5.0	1.50	1.75
C	TTW+p	MT20	3.0	4.0	2.25	1.50
D	TMVW-t	MT20	3.0	5.0	1.50	1.75
F	BMV1+p	MT20	2.0	4.0		
G	BMVWW-t	MT20	4.0	6.0		
H	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
H	650	0	650	0	5-8	5-8
F	650	0	650	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
H	454	328 / 0	0 / 0	0 / 0	0 / 0	126 / 0	0 / 0
F	454	328 / 0	0 / 0	0 / 0	0 / 0	126 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM	TO			FR-TO			
A-B	0 / 30	-77.4	-77.4	0.09 (1)	10.00	G-C	0 / 106	0.04 (4)	
B-C	-379 / 0	-77.4	-77.4	0.33 (1)	6.25	B-G	0 / 309	0.07 (1)	
C-D	-379 / 0	-77.4	-77.4	0.33 (1)	6.25	G-D	0 / 309	0.07 (1)	
D-E	0 / 30	-77.4	-77.4	0.09 (1)	10.00				
H-B	-610 / 0	0.0	0.0	0.06 (1)	7.81				
F-D	-610 / 0	0.0	0.0	0.06 (1)	7.81				
H-G	0 / 0	-18.2	-18.2	0.17 (4)	10.00				
G-F	0 / 0	-18.2	-18.2	0.17 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 23.3 PSF
DL = 3.0 PSF

BOT CH. LL = 0.0 PSF
DL = 7.3 PSF

TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.38")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.38")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.33/1.00 (B-C:1), BC=0.17/1.00 (F-G:4), WB=0.07/1.00 (B-G:1), SSI=0.14/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.51 (D) (INPUT = 0.90)
JSI METAL= 0.17 (D) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



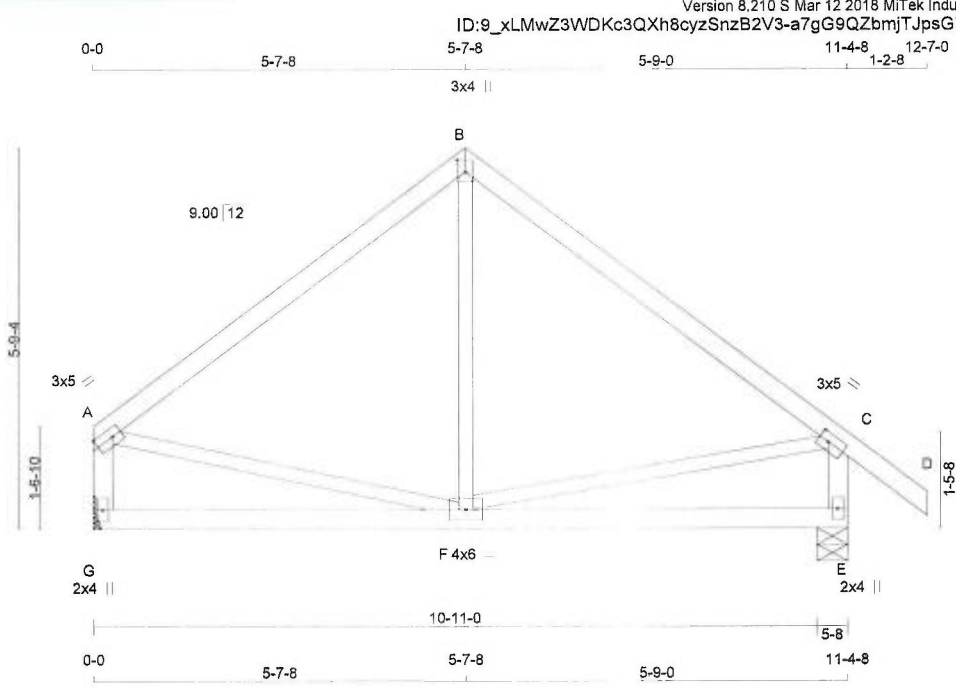

LUMBER			
N, L, G, A, RULES	CHORDS	SIZE	LUMBER
A - B	2x4	DRY	No.2
B - D	2x4	DRY	No.2
G - A	2x4	DRY	No.2
E - C	2x4	DRY	No.2
G - E	2x4	DRY	No.2

ALL WEBS EXCEPT 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	3.0	5.0	1.50	Edge
B	TTV+p	MT20	3.0	4.0	2.25	1.50
C	TMVW-t	MT20	3.0	5.0	1.50	1.75
E	BMV1+p	MT20	2.0	4.0		
F	BMVWW-t	MT20	4.0	6.0		
G	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
G	544	0	544	0	0	MECHANICAL	
E	644	0	644	0	0	5-8	5-8

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT G TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX/MIN. SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
G	382	265 / 0	0 / 0	0 / 0	0 / 0	117 / 0	0 / 0
E	450	325 / 0	0 / 0	0 / 0	0 / 0	125 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LOAD LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LOAD LC1 (LC)	UNBRACED LENGTH (FT)
FR-TO		FROM TO		FR-TO			
A-B	-371 / 0	-77.4 -77.4	0.32 (1)	6.25	F-B	0 / 103	0.04 (4)
B-C	-371 / 0	-77.4 -77.4	0.33 (1)	6.25	A-F	0 / 304	0.07 (1)
C-D	0 / 30	-77.4 -77.4	0.09 (1)	10.00	F-C	0 / 302	0.07 (1)
G-A	-508 / 0	0.0 0.0	0.05 (1)	7.81			
E-C	-601 / 0	0.0 0.0	0.06 (1)	7.81			
G-F	0 / 0	-18.2 -18.2	0.17 (4)	10.00			
F-E	0 / 0	-18.2 -18.2	0.17 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:		
TOP CH.	LL	= 23.3 PSF
	DL	= 3.0 PSF
BOT CH.	LL	= 0.0 PSF
	DL	= 7.3 PSF
TOTAL LOAD		= 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.38")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.38")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.03")

CSI: TC=0.33/1.00 (B-C:1), BC=0.17/1.00 (F-G:4), WB=0.07/1.00 (A-F:1), SSI=0.14/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.56 (F) (INPUT = 0.90)
JSI METAL= 0.17 (C) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



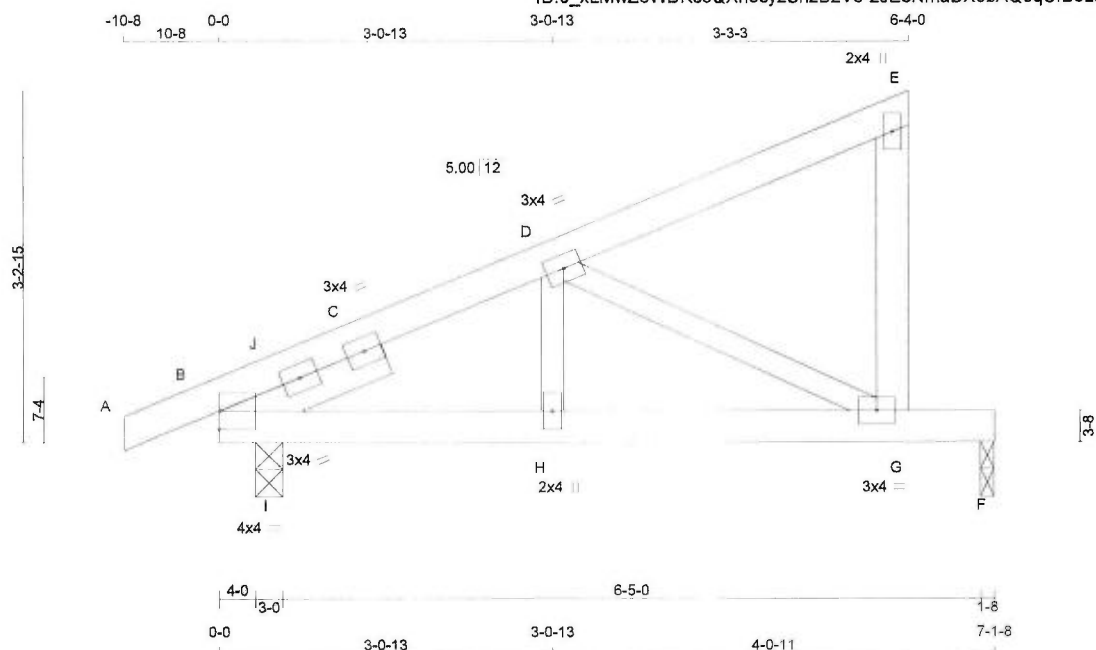

TOTAL WEIGHT = 4 X 26 = 103 LBS
[M][F]

LUMBER				DESCR.	
N. L. G. A. RULES					
CHORDS	SIZE	LUMBER		SPF	
A - E	2x4	DRY	No.2	SPF	
G - E	2x4	DRY	No.2	SPF	
B - F	2x4	DRY	No.2	SPF	
REINFORCING MEMBERS					
HW1	2x4	DRY	No.2	SPF	
ALL WEBS 2x3 DRY					
DRY: SEASONED LUMBER.			No.2	SPF	

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMBR1-I	MT20	4.0	4.0		
B	RT-t	MT20	3.0	4.0		
B	RT-t	MT20	3.0	4.0		
D	TMVW-t	MT20	3.0	4.0		
E	TMV+p	MT20	2.0	4.0		
G	BMVW-I	MT20	3.0	4.0		
H	BMV+w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER					
BEARINGS					
JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		REQRD BRG
	VERT	HORZ	DOWN	HORZ	
F	283	0	283	0	1-8
B	409	0	409	0	3-0

UNFACTORED REACTIONS							
1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	200	131 / 0	0 / 0	0 / 0	0 / 0	69 / 0	0 / 0
B	286	207 / 0	0 / 0	0 / 0	0 / 0	79 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F B

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX LC1 MAX (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 3	-77.4	-77.4 0.05 (1)	10.00	H-D	0 / 170	0.04 (1)
B-J	-415 / 0	-77.4	-77.4 0.01 (1)	6.25	D-G	-496 / 0	0.11 (1)
J-C	-384 / 0	-77.4	-77.4 0.06 (1)	6.25	C-I	-230 / 0	0.02 (1)
C-D	-384 / 0	-77.4	-77.4 0.06 (1)	6.25	I-J	0 / 153	0.00 (1)
D-E	-6 / 0	-77.4	-77.4 0.10 (1)	10.00			
G-E	-110 / 0	0.0	0.0 0.02 (1)	7.81			
B-I	0 / 297	-18.2	-18.2 0.06 (1)	10.00			
I-H	0 / 447	-18.2	-18.2 0.16 (1)	10.00			
H-G	0 / 447	-18.2	-18.2 0.37 (1)	10.00			
G-F	0 / 0	-18.2	-18.2 0.30 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.24")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.03")
ALLOWABLE DEFL.(TL)= L/360 (0.24")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.07")

CSI: TC=0.10/1.00 (D-E:1), BC=0.37/1.00 (G-H:1), WB=0.11/1.00 (D-G:1), SSI=0.22/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.68 (G) (INPUT = 0.90)
JSI METAL= 0.17 (B) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

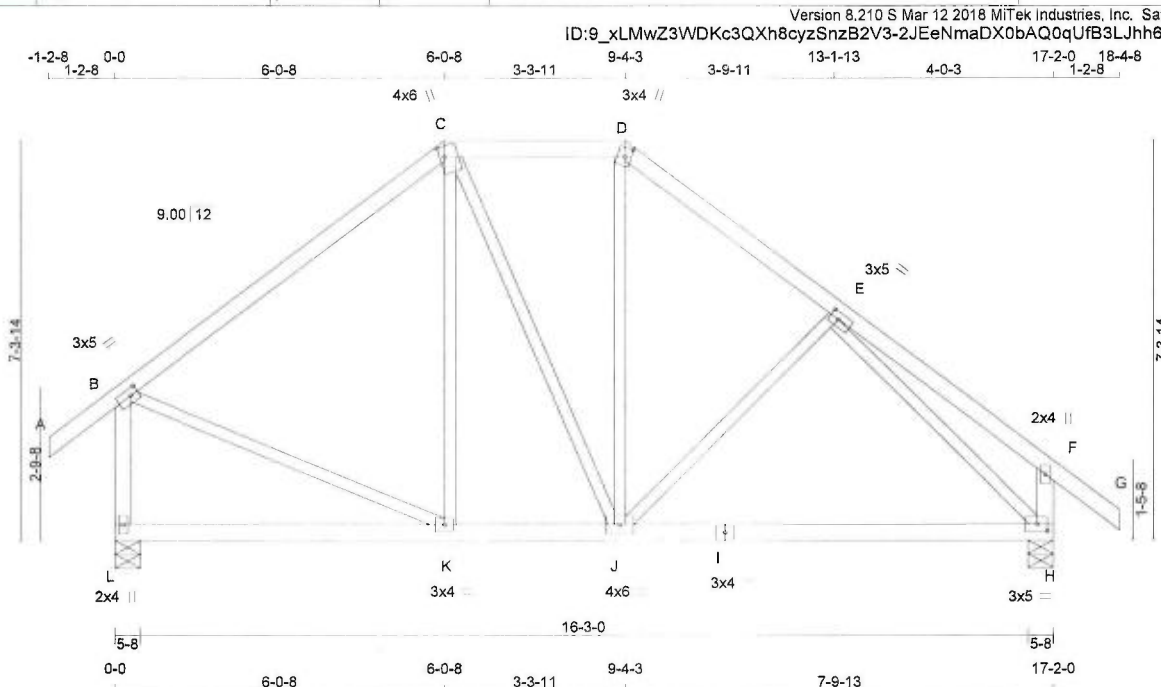

Scale = 1:42.2

TOTAL WEIGHT = 82 lb [M]/F

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
L - B	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF
L - I	2x4	DRY	No.2	SPF
I - H	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	3.0	5.0	1.50	1.75
C	TTWV+m	MT20	4.0	6.0	2.25	1.00
D	TTW+m	MT20	3.0	4.0	2.00	1.25
E	TMVW-t	MT20	3.0	5.0	1.50	2.00
F	TMV+p	MT20	2.0	4.0		
H	BMVW1-t	MT20	3.0	5.0	1.50	2.25
I	BS-t	MT20	3.0	4.0		
J	BMVWV-t	MT20	4.0	6.0		
K	BMVWV-t	MT20	3.0	4.0		
L	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION DOWN	INPUT BRG UPLIFT	REQRD BRG IN-SX
	VERT	HORZ			
L	921	0	921	0	5-8
H	921	0	921	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
L	645	460 / 0	0 / 0	0 / 0	0 / 0	185 / 0	0 / 0
H	645	460 / 0	0 / 0	0 / 0	0 / 0	185 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)
FR-TO					FR-TO		
A-B	0 / 30	-77.4	-77.4 0.09 (1)	10.00	K-C	-111 / 25	0.11 (1)
B-C	-584 / 0	-77.4	-77.4 0.37 (1)	6.25	C-J	0 / 111	0.03 (1)
C-D	-511 / 0	-77.4	-77.4 0.11 (1)	6.25	J-D	0 / 139	0.03 (4)
D-E	-659 / 0	-77.4	-77.4 0.15 (1)	6.25	E-J	-157 / 5	0.09 (1)
E-F	0 / 21	-77.4	-77.4 0.19 (1)	10.00	B-K	0 / 503	0.11 (1)
F-G	0 / 30	-77.4	-77.4 0.09 (1)	10.00	E-H	-895 / 0	0.46 (1)
L-B	-872 / 0	0.0	0.0 0.13 (1)	7.81			
H-F	-216 / 0	0.0	0.0 0.02 (1)	7.81			
L-K	0 / 0	-18.2	-18.2 0.15 (4)	10.00			
K-J	0 / 465	-18.2	-18.2 0.27 (4)	10.00			
J-I	0 / 620	-18.2	-18.2 0.28 (4)	10.00			
I-H	0 / 620	-18.2	-18.2 0.28 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	PSF
	23.3	PSF
BOT CH.	LL	PSF
	3.0	PSF
	0.0	PSF
	7.3	PSF
TOTAL LOAD	33.6	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.57")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.57")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.37/1.00 (B-C:1), BC=0.28/1.00 (H-J:4), WB=0.46/1.00 (E-H:1), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN
MT20	618	354	1667	822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (D) (INPUT = 0.90)
JSI METAL= 0.26 (E) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.




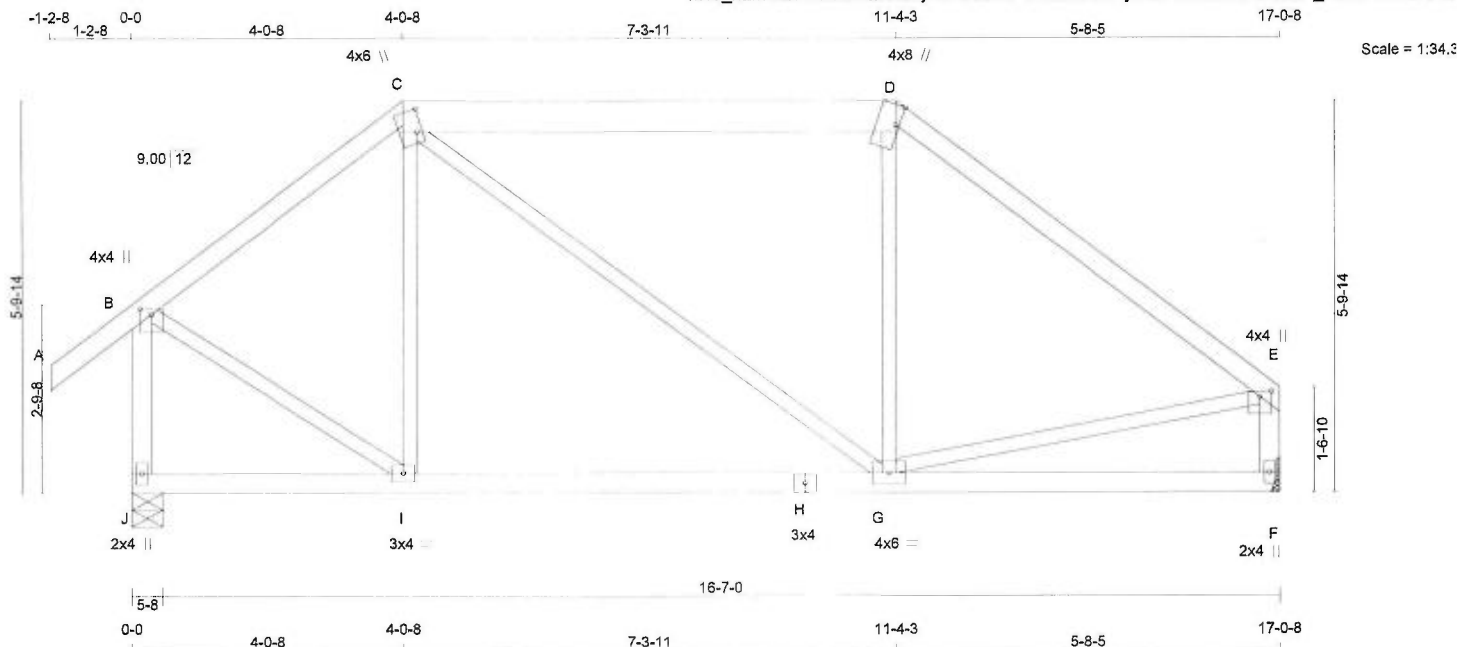

TOTAL WEIGHT = 76 lb [M]F

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
B - D	2x6	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
E - H	2x4	DRY	No.2	SPF
H - I	2x4	DRY	No.2	SPF
I - J	2x4	DRY	No.2	SPF
J - K	2x4	DRY	No.2	SPF
K - L	2x4	DRY	No.2	SPF
L - M	2x4	DRY	No.2	SPF
M - N	2x4	DRY	No.2	SPF
N - O	2x4	DRY	No.2	SPF
O - P	2x4	DRY	No.2	SPF
P - Q	2x4	DRY	No.2	SPF
Q - R	2x4	DRY	No.2	SPF
R - S	2x4	DRY	No.2	SPF
S - T	2x4	DRY	No.2	SPF
T - U	2x4	DRY	No.2	SPF
U - V	2x4	DRY	No.2	SPF
V - W	2x4	DRY	No.2	SPF
W - X	2x4	DRY	No.2	SPF
X - Y	2x4	DRY	No.2	SPF
Y - Z	2x4	DRY	No.2	SPF
Z - AA	2x4	DRY	No.2	SPF
AA - AB	2x4	DRY	No.2	SPF
AB - AC	2x4	DRY	No.2	SPF
AC - AD	2x4	DRY	No.2	SPF
AD - AE	2x4	DRY	No.2	SPF
AE - AF	2x4	DRY	No.2	SPF
AF - AG	2x4	DRY	No.2	SPF
AG - AH	2x4	DRY	No.2	SPF
AH - AI	2x4	DRY	No.2	SPF
AI - AJ	2x4	DRY	No.2	SPF
AJ - AK	2x4	DRY	No.2	SPF
AK - AL	2x4	DRY	No.2	SPF
AL - AM	2x4	DRY	No.2	SPF
AM - AN	2x4	DRY	No.2	SPF
AN - AO	2x4	DRY	No.2	SPF
AO - AP	2x4	DRY	No.2	SPF
AP - AQ	2x4	DRY	No.2	SPF
AQ - AR	2x4	DRY	No.2	SPF
AR - AS	2x4	DRY	No.2	SPF
AS - AT	2x4	DRY	No.2	SPF
AT - AU	2x4	DRY	No.2	SPF
AU - AV	2x4	DRY	No.2	SPF
AV - AW	2x4	DRY	No.2	SPF
AW - AX	2x4	DRY	No.2	SPF
AX - AY	2x4	DRY	No.2	SPF
AY - AZ	2x4	DRY	No.2	SPF
AZ - BA	2x4	DRY	No.2	SPF
BA - BB	2x4	DRY	No.2	SPF
BB - BC	2x4	DRY	No.2	SPF
BC - BD	2x4	DRY	No.2	SPF
BD - BE	2x4	DRY	No.2	SPF
BE - BF	2x4	DRY	No.2	SPF
BF - BG	2x4	DRY	No.2	SPF
BG - BH	2x4	DRY	No.2	SPF
BH - BI	2x4	DRY	No.2	SPF
BI - BJ	2x4	DRY	No.2	SPF
BJ - BK	2x4	DRY	No.2	SPF
BK - BL	2x4	DRY	No.2	SPF
BL - BM	2x4	DRY	No.2	SPF
BM - BN	2x4	DRY	No.2	SPF
BN - BO	2x4	DRY	No.2	SPF
BO - BP	2x4	DRY	No.2	SPF
BP - BQ	2x4	DRY	No.2	SPF
BQ - BR	2x4	DRY	No.2	SPF
BR - BS	2x4	DRY	No.2	SPF
BS - BT	2x4	DRY	No.2	SPF
BT - BU	2x4	DRY	No.2	SPF
BU - BV	2x4	DRY	No.2	SPF
BV - BW	2x4	DRY	No.2	SPF
BW - BX	2x4	DRY	No.2	SPF
BX - BY	2x4	DRY	No.2	SPF
BY - BZ	2x4	DRY	No.2	SPF
BZ - CA	2x4	DRY	No.2	SPF
CA - CB	2x4	DRY	No.2	SPF
CB - CC	2x4	DRY	No.2	SPF
CC - CD	2x4	DRY	No.2	SPF
CD - CE	2x4	DRY	No.2	SPF
CE - CF	2x4	DRY	No.2	SPF
CF - CG	2x4	DRY	No.2	SPF
CG - CH	2x4	DRY	No.2	SPF
CH - CI	2x4	DRY	No.2	SPF
CI - CJ	2x4	DRY	No.2	SPF
CJ - CK	2x4	DRY	No.2	SPF
CK - CL	2x4	DRY	No.2	SPF
CL - CM	2x4	DRY	No.2	SPF
CM - CN	2x4	DRY	No.2	SPF
CN - CO	2x4	DRY	No.2	SPF
CO - CP	2x4	DRY	No.2	SPF
CP - CQ	2x4	DRY	No.2	SPF
CQ - CR	2x4	DRY	No.2	SPF
CR - CS	2x4	DRY	No.2	SPF
CS - CT	2x4	DRY	No.2	SPF
CT - CU	2x4	DRY	No.2	SPF
CU - CV	2x4	DRY	No.2	SPF
CV - CW	2x4	DRY	No.2	SPF
CW - CX	2x4	DRY	No.2	SPF
CX - CY	2x4	DRY	No.2	SPF
CY - CZ	2x4	DRY	No.2	SPF
CZ - DA	2x4	DRY	No.2	SPF
DA - DB	2x4	DRY	No.2	SPF
DB - DC	2x4	DRY	No.2	SPF
DC - DD	2x4	DRY	No.2	SPF
DD - DE	2x4	DRY	No.2	SPF
DE - DF	2x4	DRY	No.2	SPF
DF - DG	2x4	DRY	No.2	SPF
DG - DH	2x4	DRY	No.2	SPF
DH - DI	2x4	DRY	No.2	SPF
DI - DJ	2x4	DRY	No.2	SPF
DJ - DK	2x4	DRY	No.2	SPF
DK - DL	2x4	DRY	No.2	SPF
DL - DM	2x4	DRY	No.2	SPF
DM - DN	2x4	DRY	No.2	SPF
DN - DO	2x4	DRY	No.2	SPF
DO - DP	2x4	DRY	No.2	SPF
DP - DQ	2x4	DRY	No.2	SPF
DQ - DR	2x4	DRY	No.2	SPF
DR - DS	2x4	DRY	No.2	SPF
DS - DT	2x4	DRY	No.2	SPF
DT - DU	2x4	DRY	No.2	SPF
DU - DV	2x4	DRY	No.2	SPF
DV - DW	2x4	DRY	No.2	SPF
DW - DX	2x4	DRY	No.2	SPF
DX - DY	2x4	DRY	No.2	SPF
DY - DZ	2x4	DRY	No.2	SPF
DZ - EA	2x4	DRY	No.2	SPF
EA - EB	2x4	DRY	No.2	SPF
EB - EC	2x4	DRY	No.2	SPF
EC - ED	2x4	DRY	No.2	SPF
ED - EE	2x4	DRY	No.2	SPF
EE - EF	2x4	DRY	No.2	SPF
EF - EG	2x4	DRY	No.2	SPF
EG - EH	2x4	DRY	No.2	SPF
EH - EI	2x4	DRY	No.2	SPF
EI - EJ	2x4	DRY	No.2	SPF
EJ - EK	2x4	DRY	No.2	SPF
EK - EL	2x4	DRY	No.2	SPF
EL - EM	2x4	DRY	No.2	SPF
EM - EN	2x4	DRY	No.2	SPF
EN - EO	2x4	DRY	No.2	SPF
EO - EP	2x4	DRY	No.2	SPF
EP - EQ	2x4	DRY	No.2	SPF
EQ - ER	2x4	DRY	No.2	SPF
ER - ES	2x4	DRY	No.2	SPF
ES - ET	2x4	DRY	No.2	SPF
ET - EU	2x4	DRY	No.2	SPF
EU - EV	2x4	DRY	No.2	SPF
EV - EW	2x4	DRY	No.2	SPF
EW - EX	2x4	DRY	No.2	SPF
EX - EY	2x4	DRY	No.2	SPF
EY - EZ	2x4	DRY	No.2	SPF
EZ - FA	2x4	DRY	No.2	SPF
FA - FB	2x4	DRY	No.2	SPF
FB - FC	2x4	DRY	No.2	SPF
FC - FD	2x4	DRY	No.2	SPF
FD - FE	2x4	DRY	No.2	SPF
FE - FF	2x4	DRY	No.2	SPF
FF - FG	2x4	DRY	No.2	SPF
FG - FH	2x4	DRY	No.2	SPF
FH - FI	2x4	DRY	No.2	SPF
FI - FJ	2x4	DRY	No.2	SPF
FJ - FK	2x4	DRY	No.2	SPF
FK - FL	2x4	DRY	No.2	SPF
FL - FM	2x4	DRY	No.2	SPF
FM - FN	2x4	DRY	No.2	SPF
FN - FO	2x4	DRY	No.2	SPF
FO - FP	2x4	DRY	No.2	SPF
FP - FQ	2x4	DRY	No.2	SPF
FQ - FR	2x4	DRY	No.2	SPF
FR - FS	2x4	DRY	No.2	SPF
FS - FT	2x4	DRY	No.2	SPF
FT - FU	2x4	DRY	No.2	SPF
FU - FV	2x4	DRY	No.2	SPF
FV - FW	2x4	DRY	No.2	SPF
FW - FX	2x4	DRY	No.2	SPF
FX - FY	2x4	DRY	No.2	SPF
FY - FZ	2x4	DRY	No.2	SPF
FZ - GA	2x4	DRY	No.2	SPF
GA - GB	2x4	DRY	No.2	SPF
GB - GC	2x4	DRY	No.2	SPF
GC - GD	2x4	DRY	No.2	SPF
GD - GE	2x4	DRY	No.2	SPF
GE - GF	2x4	DRY	No.2	SPF
GF - GG	2x4	DRY	No.2	SPF
GG - GH	2x4	DRY	No.2	SPF
GH - GI	2x4	DRY	No.2	SPF
GI - GJ	2x4	DRY	No.2	SPF
GJ - GK	2x4	DRY	No.2	SPF
GK - GL	2x4	DRY	No.2	SPF
GL - GM	2x4	DRY	No.2	SPF
GM - GN	2x4	DRY	No.2	SPF
GN - GO	2x4	DRY	No.2	SPF
GO - GP	2x4	DRY	No.2	SPF
GP - GQ	2x4	DRY	No.2	SPF
GQ - GR	2x4	DRY	No.2	SPF
GR - GS	2x4	DRY	No.2	SPF
GS - GT	2x4	DRY	No.2	SPF
GT - GU	2x4	DRY	No.2	SPF
GU - GV	2x4	DRY	No.2	SPF
GV - GW	2x4	DRY	No.2	SPF
GW - GX	2x4	DRY	No.2	SPF
GX - GY	2x4	DRY	No.2	SPF
GY - GZ	2x4	DRY	No.2	SPF
GZ - HA	2x4	DRY	No.2	SPF
HA - HB	2x4	DRY	No.2	SPF
HB - HC	2x4	DRY	No.2	SPF
HC - HD	2x4	DRY	No.2	SPF
HD - HE	2x4	DRY	No.2	SPF
HE - HF	2x4	DRY	No.2	SPF
HF - HG	2x4	DRY	No.2	SPF
HG - HH	2x4	DRY	No.2	SPF
HH - HI	2x4	DRY	No.2	SPF
HI - HJ	2x4	DRY	No.2	SPF
HJ - HK	2x4	DRY	No.2	SPF
HK - HL	2x4	DRY	No.2	SPF
HL - HM	2x4	DRY	No.2	SPF
HM - HN	2x4	DRY	No.2	SPF
HN - HO	2x4	DRY	No.2	SPF
HO - HP	2x4	DRY	No.2	SPF
HP - HQ	2x4	DRY	No.2	SPF
HQ - HR	2x4	DRY	No.2	SPF
HR - HS	2x4	DRY	No.2	SPF
HS - HT	2x4	DRY	No.2	SPF
HT - HU	2x4	DRY	No.2	SPF
HU - HV	2x4	DRY	No.2	SPF
HV - HW	2x4	DRY	No.2	SPF
HW - HX	2x4	DRY	No.2	SPF
HX - HY	2x4	DRY	No.2	SPF
HY - HZ	2x4	DRY	No.2	SPF
HZ - IA	2x4	DRY	No.2	SPF
IA - IB	2x4	DRY	No.2	SPF
IB - IC	2x4	DRY	No.2	SPF
IC - ID	2x4	DRY	No.2	SPF
ID - IE	2x4	DRY	No.2	SPF
IE - IF	2x4	DRY	No.2	SPF
IF - IG	2x4	DRY	No.2	SPF
IG - IH	2x4	DRY	No.2	SPF
IH - II	2x4	DRY	No.2	SPF
II - IJ	2x4	DRY	No.2	SPF
IJ - IK	2x4	DRY	No.2	SPF
IK - IL	2x4	DRY	No.2	SPF
IL - IM	2x4	DRY	No.2	SPF
IM - IN	2x4	DRY	No.2	SPF
IN - IO	2x4	DRY	No.2	SPF
IO - IP	2x4	DRY	No.2	SPF
IP - IQ	2x4	DRY	No.2	SPF
IQ - IR	2x4	DRY	No.2	SPF
IR - IS	2x4	DRY	No.2	SPF
IS - IT	2x4	DRY	No.2	SPF
IT - IU	2x4	DRY	No.2	SPF
IU - IV	2x4	DRY	No.2	SPF
IV - IW	2x4	DRY	No.2	SPF
IW - IX	2x4	DRY	No.2	SPF
IX - IY	2x4	DRY	No.2	SPF
IY - IZ	2x4	DRY	No.2	SPF
IZ - JA	2x4	DRY	No.2	SPF
JA - JB	2x4	DRY	No.2	SPF
JB - JC	2x4	DRY	No.2	SPF
JC - JD	2x4	DRY	No.2	SPF
JD - JE	2x4	DRY	No.2	SPF
JE - JF	2x4	DRY	No.2	SPF
JF - JG	2x4	DRY	No.2	SPF
JG - JH	2x4	DRY	No.2	SPF
JH - JI	2x4	DRY	No.2	SPF
JI - JJ	2x4	DRY	No.2	SPF
JJ - JK	2x4	DRY	No.2	SPF
JK - JL	2x4	DRY	No.2	SPF
JL - JM	2x4	DRY	No.2	SPF
JM - JN	2x4	DRY	No.2	SPF
JN - JO	2x4	DRY	No.2	SPF
JO - JP	2x4	DRY	No.2	SPF
JP - JQ	2x4	DRY	No.2	SPF

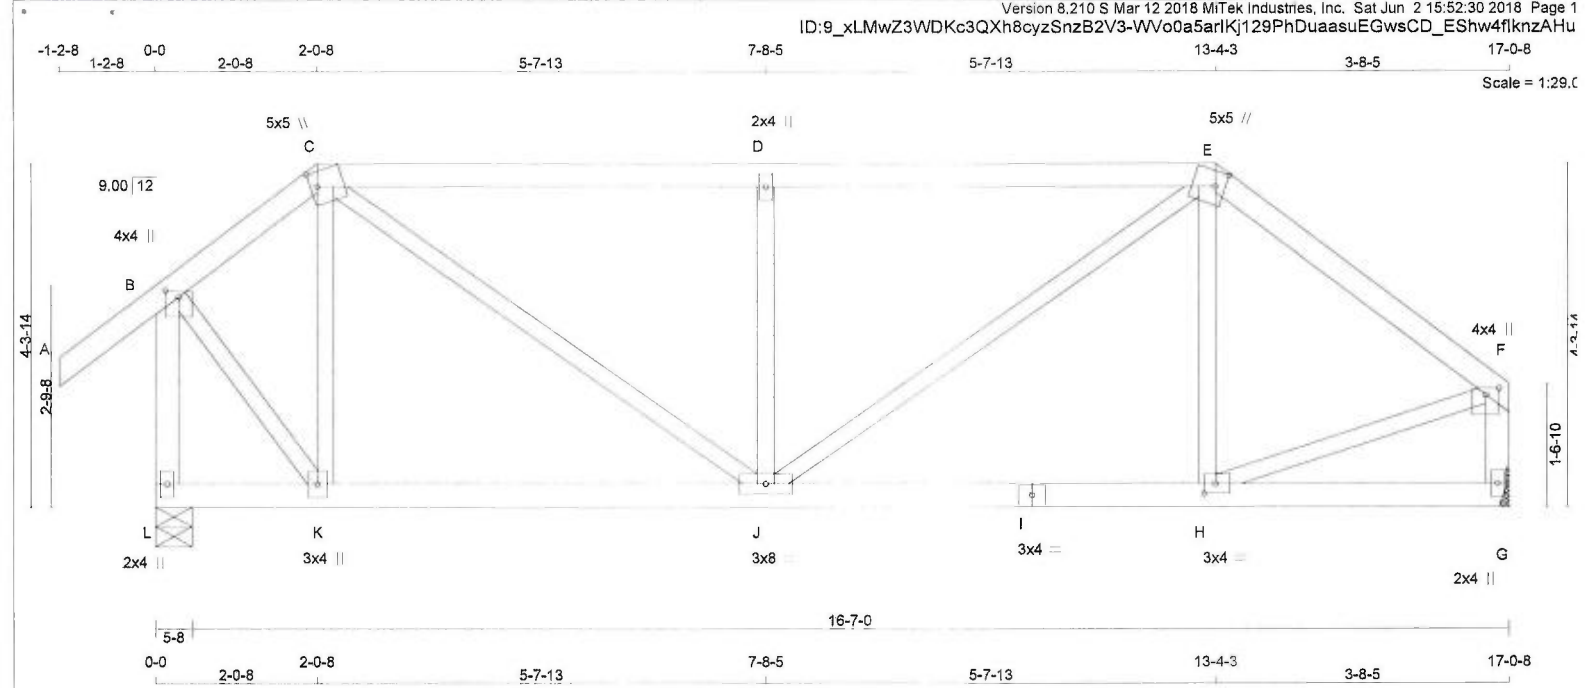

LUMBER				N. L. G. A. RULES				CHORDS				SIZE				LUMBER				DESCR.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER												TOTAL WEIGHT = 72 lb (M)																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																											
A - C				2x4				DRY				No.2				SPF				FACTORED GROSS REACTION				MAXIMUM FACTORED GROSS REACTION				INPUT				REQRD				SPECIFIED LOADS:				DESIGN CRITERIA																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																							
C - E				2x4				DRY				No.2				SPF				VERT				HORZ				DOWN				HORZ				UPLIFT				IN-SX				IN-SX				TOP CH. LL = 23.3 PSF				DL = 3.0 PSF																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																											
E - F				2x4				DRY				No.2				SPF				L				915				0				915				0				0				5-8				5-8				BOT CH. LL = 0.0 PSF				DL = 7.3 PSF																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																							
L - B				2x4				DRY				No.2				SPF				G				815				0				815				0				0				MECHANICAL				TOTAL LOAD = 33.6 PSF				SPACING = 24.0 IN. C/C																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																											
G - F				2x4				DRY				No.2				SPF				A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT G TO RESIST THE MAX FACTORED REACTIONS.				UNFACTORED REACTIONS				LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM				THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010				THIS DESIGN COMPLIES WITH:				- PART 9 OF OBC 2012, BCBC 2012, ABC 2014				- CSA 086-09				- TPIC 2011																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																															
L - I				2x4				DRY				No.2				SPF				1ST LCASE				MAX./MIN. COMPONENT REACTIONS				WIND				DEAD				SOIL				(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD				ALLOWABLE DEFL.(LL)= L/360 (0.57")				CALCULATED VERT. DEFL.(LL) = L/ 999 (0.02")				ALLOWABLE DEFL.(TL)= L/360 (0.57")				CALCULATED VERT. DEFL.(TL) = L/ 999 (0.05")				CSI: TC=0.44/1.00 (D-E:1), BC=0.16/1.00 (H-J:4), WB=0.15/1.00 (C-J:1), SSI=0.21/1.00 (D-E:1)				DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10				COMPANION LIVE LOAD FACTOR = 0.50				TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .				NAIL VALUES				PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)				MAX MIN MAX MIN MAX MIN				MT20 618 354 1667 822 2284 1656				PLATE PLACEMENT TOL. = 0.250 inches				PLATE ROTATION TOL. = 5.0 Deg.				JSI GRIP= 0.90 (C) (INPUT = 0.90)				JSI METAL= 0.22 (H) (INPUT = 1.00)																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																							
I - G				2x4				DRY				No.2				SPF				JT				COMBINED				SNOW				LIVE				PERM.LIVE				WIND				DEAD				SOIL				TOTAL LOAD CASES: (4)				CHORDS				MAX. FACTORED				FACTORED				WEBS				MAX. FACTORED				MEMB.				FORCE				MAX				FORCE				MAX				CSI (LC)				CSI (LC)				FR-TO				FROM TO				LENGTH FR-TO				FR-TO				K- C				-354 / 0				0.10 (1)				B- C				-484 / 0				-77.4 -77.4				0.06 (1)				6.25				C- J				0 / 687				0.15 (1)				C- D				-936 / 0				-77.4 -77.4				0.44 (1)				5.75				J- D				-536 / 0				0.15 (1)				D- E				-936 / 0				-77.4 -77.4				0.44 (1)				5.75				J- E				0 / 413				0.09 (1)				E- F				-753 / 0				-77.4 -77.4				0.19 (1)				6.25				H- E				-98 / 44				0.03 (1)				L- B				-914 / 0				0.0 0.0				0.14 (1)				7.81				B- K				0 / 586				0.13 (1)				G- F				-791 / 0				0.0 0.0				0.08 (1)				7.81				H- F				0 / 632				0.14 (1)				L- K				0 / 0				-18.2 -18.2				0.08 (4)				10.00				K- J				0 / 376				-18.2 -18.2				0.14 (4)				10.00				J- I				0 / 599				-18.2 -18.2				0.16 (4)				10.00				I- H				0 / 599				-18.2 -18.2				0.16 (4)				10.00				H- G				0 / 0				-18.2 -18.2				0.09 (4)				10.00																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																											
ALL WEBS EXCEPT				2x3				DRY				No.2				SPF				ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.				LOADING				TOTAL LOAD CASES: (4)				CHORDS				MAX. FACTORED				FACTORED				WEBS				MAX. FACTORED				MEMB.				FORCE				MAX				FORCE				MAX				CSI (LC)				CSI (LC)				FR-TO				FROM TO				LENGTH FR-TO				FR-TO				K- C				-354 / 0				0.10 (1)				B- C				-484 / 0				-77.4 -77.4				0.06 (1)				6.25				C- J				0 / 687				0.15 (1)				C- D				-936 / 0				-77.4 -77.4				0.44 (1)				5.75				J- D				-536 / 0				0.15 (1)				D- E				-936 / 0				-77.4 -77.4				0.44 (1)				5.75				J- E				0 / 413				0.09 (1)				E- F				-753 / 0				-77.4 -77.4				0.19 (1)				6.25				H- E				-98 / 44				0.03 (1)				L- B				-914 / 0				0.0 0.0				0.14 (1)				7.81				B- K				0 / 586				0.13 (1)				G- F				-791 / 0				0.0 0.0				0.08 (1)				7.81				H- F				0 / 632				0.14 (1)				L- K				0 / 0				-18.2 -18.2				0.08 (4)				10.00				K- J				0 / 376				-18.2 -18.2				0.14 (4)				10.00				J- I				0 / 599				-18.2 -18.2				0.16 (4)				10.00				I- H				0 / 599				-18.2 -18.2				0.16 (4)				10.00				H- G				0 / 0				-18.2 -18.2				0.09 (4)				10.00																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																			
DRY: SEASONED LUMBER.																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																															

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.




BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B37579H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-09, section 10.9.4.1.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-09, section 10.9.4
10. This design is not valid after April 30, 2019.

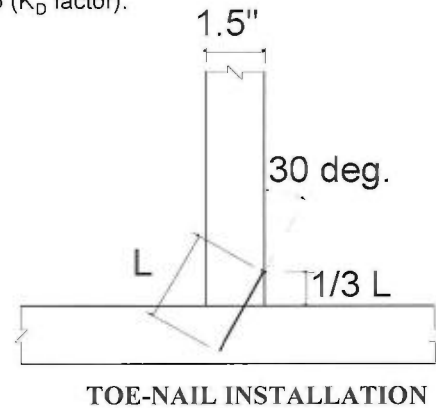

Nail type	Common wire	Common spiral	Common wire
Nail dia. (in)	0.160	0.152	0.144
	(3.5" nail)		(3" and 3.25" nail)
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS		
2X4 SPF	2	2	3
2X4 D. Fir	2	2	2
2X6 SPF	4	4	4
2X6 D. Fir	3	3	3



MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

PEO
Certificate No. 10889485



April 26, 2017

BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B37579H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind or earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-09, section 10.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-09, section 10.9.5
9. This design is not valid after April 30, 2019

Toe-nailing on 2x6 Bearing Plate

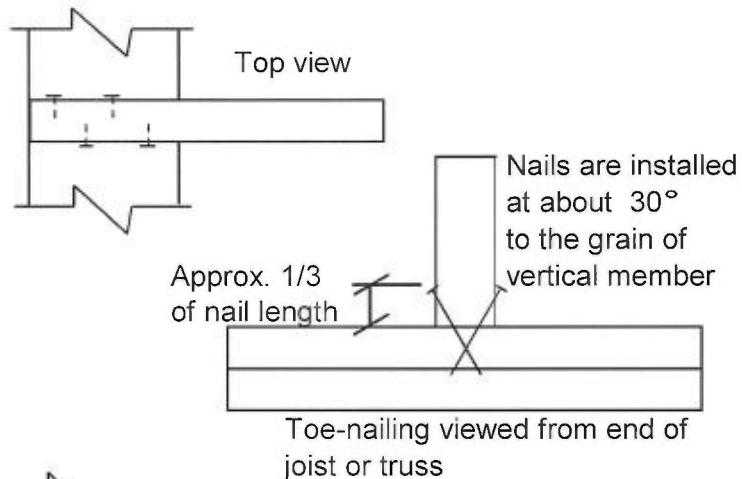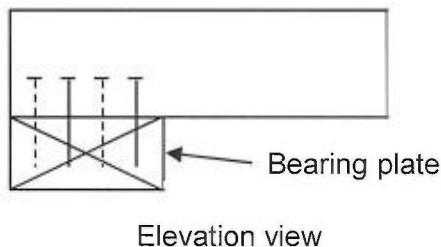

Toe-nailing on 2x4 Bearing Plate

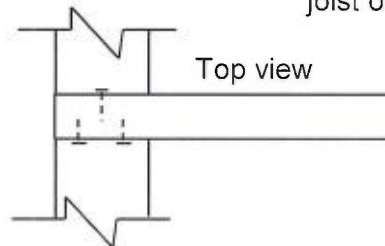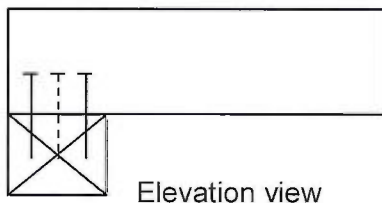

MiTek Canada Inc
100 Industrial Rd
Bradford, Ontario L3Z 3G7

PEO
Certificate No. 10889485



April 26, 2017