

FRANK FISHER CRESCENT

<div>Owner/Applicant</div> <div>DCR/PHOENIX HOMES</div> <div>Telephone # 723-9227</div> <div>Plan # 27M- 47</div> <div>Project name: WHITE TAIL RIDGE</div> <div>Civic Address:168 FRANK FISHER CRESCENT</div> <div>House model: BIRCHWOOD C</div>		<div><div><div><div></div></div><div>PHOENIX HOMES</div></div><div><div>LOT 118</div><div>SITE/GRADING PLAN</div><div>WHITE TAIL RIDGE PH.II</div></div></div>
<div>Bldg. Ht. 8.84 m</div> <div>Lot coverage 12.5 %</div> <div>Scale 1:250</div> <div>Sod Area 1539 m<sup>2</sup></div> <div>Asphalt Area 87 m<sup>2</sup></div>		<div>INDIVIDUAL LOT GRADING REVIEW SUMMARY FOR SITED HOUSE AS COMPARED WITH OVERALL SUBDIVISION PLAN</div>
<div>CHECKED/APPROVED BY: T.L.MAK ENG.</div> <div>APR. 17, 2023 - CB</div> <div>MAY 08, 2023 - CB - ADDRESS CHANGE</div> <div>JUN. 02, 2023 - CB</div>		<div>NOTE: THIS PLAN IS NOT A SURVEY PLAN OR SUBDIVISION PLAN WITHIN THE MEANING OF PLANNING ACT.</div> <div>THIS PLAN IS FOR REFERENCE ONLY AND IS PRELIMINARY IN NATURE, ALL DIMENSIONS SHOWN ARE APPROXIMATE. E,O&amp;E.</div>

CONSTRUCTION NOTES

ALL CONSTRUCTION TO ADHERE TO THESE PLANS AND SPEC'S AND TO CONFORM TO THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE CODES AND AUTHORITIES HAVING JURISDICTION. THESE REQUIREMENTS ARE TO BE TAKEN AS MINIMUM SPECIFICATIONS. ONT. REG. 332/12

1.

**ROOF CONSTRUCTION**  
NO.210 (10.25kg/m2) ASPHALT SHINGLES, 11.1mm (7/16") ASPENITE SHEATHING WITH "H" CLIPS. APPROVED WOOD TRUSSES @ 600mm (24") O.C. MAX. APPROVED EAVES PROTECTION TO EXTEND 900mm (3'-0") FROM EDGE OF ROOF AND MIN. 300mm (12") BEYOND INNER FACE OF EXTERIOR WALL. (EAVES PROTECTION NOT REQ'D. FOR ROOF 8:12 OR GREATER) 38x89 (2"x4") TRUSS BRACING @ 1830mm (6'-0") O.C. AT BOTTOM CHORD. PREFIN. ALUM. EAVESTROUGH, FASCIA, RWL & VENTED SOFFIT. ATTIC VENTILATION 1:300 OF INSULATED CEILING AREA WITH 25% AT EAVES. AND 25% AT RIDGE (OBC 9.19.1.2)
2.

**FRAME WALL CONSTRUCTION (2"x6")**  
SIDING AS PER ELEVATION, APPROVED AIR BARRIER 11.1mm (7/16") EXTERIOR TYPE SHEATHING, 38x140 (2"x6") STUDS @ 400mm (16") O.C., RSI 3.87 (R22) INSULATION AND APPROVED VAPOUR BARRIER AND APPROVED CONT. AIR BARRIER, 13mm (1/2") INT. DRYWALL FINISH. SIDING TO BE MIN. 200mm (8") ABOVE FIN. GRADE
- 2A.

**FRAME WALL CONSTRUCTION (2"x4" GARAGE WALL)**  
SIDING AS PER ELEVATION, APPROVED AIR BARRIER, 38x89 (2"x4") STUDS @ 400mm (16") O.C., [FOR CLIENT UPGRADE ONLY - RSI 3.35 (R19) INSULATION AND APPROVED VAPOUR BARRIER, 13mm (1/2") INT. DRYWALL FINISH.] SIDING TO BE MIN. 200mm (8") ABOVE FIN. GRADE
3.

**BRICK VENEER CONSTRUCTION (2"x6")**  
90mm (4") FACE BRICK 25mm (1") AIR SPACE, 22x180x0.76mm (7/8"x7"x0.03") GALV. METAL TIES @ 400mm (16") O.C. HORIZONTAL 600mm (24") O.C. VERTICAL. APPROVED AIR BARRIER 11.1mm (7/16") EXTERIOR TYPE SHEATHING, 38x140 (2"x6") STUDS @ 400mm (16") O.C., RSI 3.87 (R22) INSULATION AND APPROVED VAPOUR BARRIER WITH APPROVED CONTIN. AIR BARRIER. 13mm (1/2") INT. DRYWALL FINISH. PROVIDE WEEP HOLES @ 800mm (32") O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE THRU-WALL FLASHING UP MIN. 150mm (6") BEHIND BUILDING PAPER. BRICK TO BE MIN. 150mm (6") ABOVE FINISH GRADE.
- 3A.

**BRICK VENEER CONSTRUCTION (2"x4" GARAGE WALL)**  
90mm (4") FACE BRICK 25mm (1") AIR SPACE, 22x180x0.76mm (7/8"x7"x0.03") GALV. METAL TIES @ 400mm (16") O.C. HORIZONTAL 600mm (24") O.C. VERTICAL. APPROVED AIR BARRIER, 38x89 (2"x4") STUDS @ 400mm (16") O.C. [FOR CLIENT UPGRADE ONLY - RSI 3.35 (R19) INSULATION AND APPROVED VAPOUR BARRIER, 13mm (1/2") INT. DRYWALL FINISH.] PROVIDE WEEP HOLES @ 800mm (32") O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE THRU-WALL FLASHING UP MIN. 150mm (6") BEHIND BUILDING PAPER. BRICK TO BE MIN. 150MM(6") ABOVE FINISH GRADE.
4.

**INTERIOR STUD PARTITIONS** FOR BEARING PARTITIONS 38x89 (2"x4") @ 400mm (16") O.C. FOR 2 STOREYS AND 300mm (12") O.C. FOR 3 STOREYS, NON-BEARING PARTITIONS 38x89 (2"x4") @ 600mm (24") O.C. PROVIDE 38x89 (2"x4") BOTTOM PLATE AND 2/38x89 (2/2"x4") TOP PLATE. 13mm (1/2") INT. DRYWALL BOTH SIDES OF STUDS, PROVIDE 38x140 (2"x6") STUDS/PLATES WHERE NOTED.
5.

**FOUNDATION WALL/FOOTINGS: -SEE OBC 9.15.3, 9.15.4** 200mm (8") POURED CONC. FDTN. WALL 20MPa (c/w 2-15M REBAR TOP & BOTTOM) WITH BITUMENOUS DAMPPROOFING AND OPT. DRAINAGE LAYER. DRAINAGE LAYER REQ. WHEN BASEMENT INSUL. EXTENDS 900 (2'-11") BELOW FIN. GRADE. MAXIMUM POUR HEIGHT 2390 (7'-10") ON 500x155 (20"x6") CONTINUOUS KEYS/CONC. FTG. BRACE FDTN. WALL PRIOR TO BACKFILLING. ALL FOOTINGS SHALL REST ON NATURAL UNDISTURBED SOIL OR COMPACTED ENGINEERED FILL, WITH MIN. BEARING CAPACITY OF 100kPa OR GREATER. IF SOIL BEARING DOES NOT MEET MIN. CAPACITY, ENGINEERED FOOTINGS ARE REQUIRED. MAX. FLOOR LIVE LOAD OF 2.4kpa(50psf) PER FLOOR, AND MAX. LENGTH OF SUPPORTED JOISTS IS 4.9m (16'-1"). REFER TO SOILS REPORT FOR SOILS CONDITIONS AND BEARING CAPACITY.
6.

100mm (4") DIA. WEEP TILE 150mm (6") CRUSHED STONE OVER AND AROUND WEEPING TILES.
7.

**BASEMENT SLAB** OBC. 9.3.1.6.(1)(b) & 9.16.4.5.(1) 80mm (3")MIN. 25MPa (3600psi) CONC. SLAB ON 100mm (4") COARSE GRANULAR FILL, OR 15MPa. (2200psi) CONC. WITH DAMPPROOFING BELOW SLAB.
8.

**EXPOSED FLOOR TO EXTERIOR** PROVIDE RSI 5.46 (R31) INSULATION, APPROVED VAPOUR BARRIER AND CONTINUOUS AIR BARRIER, FINISHED SOFFIT.
9.

OBC. 12.3.2.1 & 12.3.3.7 **ATTIC INSULATION** RSI 8.81 (R60) BLOWN IN ROOF INSULATION AND APPROVED VAPOUR BARRIER, 13mm (1/2") INT. DRYWALL FINISH OR APPROVED EQUAL.
10.

**STAIRS, STEPS, HANDRAILS -OBC. 9.8.-**  
-9.8.2.1(2) STAIR WIDTH MEASURED BETWEEN WALL FACES OR GUARDS SHALL BE NOT LESS THAN 860mm (33 7/8") FOR REQUIRED EXIT STAIRS SERVING A HOUSE OR DWELLING UNIT. -9.8.2.2(3) CLEAR HEIGHT OVER STAIRS SHALL NOT BE LESS THAN 1950mm (76 3/4")  
-9.8.4 STEP DIMENSIONS (TABLE 9.8.4.1)  

STAIR COMPONENT	MINIMUM	MAXIMUM
RISE	125mm (4 11/16")	200mm (7 7/8")
RUN	255mm (10 1/16")	355mm (14")

  
-9.8.4.4 UNIFORMITY & TOLERANCES FOR RISERS & TREADS  
-BETWEEN ADJACENT TREADS & LANDINGS = 5mm  
-BETWEEN TALLEST & SHORTEST RISER IN FLIGHT=10mm  
-9.8.4.6(1)(b) MAX. NOSING 25mm (1")  
-9.8.7.5(1)(b) CLEARANCE BETWEEN HANDRAIL AND SURFACE BEHIND IT TO BE MIN. 50mm (1 13/16")  
-9.8.7.6(1) HANDRAILS SHALL NOT PROJECT MORE THAN 100mm (3 13/16") INTO REQUIRED WIDTH OF STAIR <SEE 9.8.2.1(1)>  
GUARDS -OBC. 9.8.8.3-  
(1) EXT. GUARDS HEIGHT: =1070mm (42 1/2") MIN.  
(2) INT. GUARDS HEIGHT: =900mm (35 15/16") MIN.  
(1) STAIR LANDING GUARDS: =1070mm (42 1/8") MIN.  
-9.8.8.5(1) MAX. OPENINGS THROUGH GUARDS =100mm (3 15/16")
11.

38x89 (2"x4") SILL PLATE WITH 13mm (1/2") DIA. ANCHOR BOLTS 200mm (8") LONG, EMBEDDED MIN. 100mm (4") INTO CONC. @ 2400mm (7'-10") O.C. USE NON-SHRINK GROUT TO LEVEL SILL PLATE WHEN REQUIRED. (SEE OBC. 9.23.7)
13.

-R12 (3 3/4") CONTINUOUS BATT INSULATION. 2"x4" STUD WALL PLACED 3 3/4" AWAY FROM WALL. FILL STUD CAVITY WITH R10 BATT INSULATION. APPROVED VB TO 8" ABOVE FLOOR LEVEL.  
OR  
-APPROVED BLANKET INSULATION (R20) MECHANICALLY SECURED TO CONCRETE FOUNDATION WALL WITH 100mm HILTI PINS (COMES WITH PLASTIC WASHER)  
  
DAMPPROOF WITH BUILDING PAPER BETWEEN THE FOUNDATION WALL AND INSULATION UP TO GRADE LEVEL.  
  
(SEE DETAIL ON "SB-12 DETAILS" PAGE)

14.

**BEARING STUD PARTITION**  
38x89 (2"x4") STUDS @ 400mm (16") O.C. 38x89 (2"x4") SILL PLATE ON DAMPPROOFING MATERIAL, 13mm (1/2") DIA. ANCHOR BOLTS 200mm (8") LONG, EMBEDDED MIN. 100mm (4") INTO CONC. @ 2400mm (7'-10") O.C. 100mm (4") HIGH CONC. CURB ON 350x155 (14"x6") CONC. FOOTING. ADD HORIZ. BLOCKING AT MID-HEIGHT IF WALL IS UNFINISHED.
15.

**STEEL BASEMENT COLUMN (SEE O.B.C. 9.17.3.1, 9.17.3.4)**  
75mm (3") DIA. ADJUSTABLE STL. COL. CONFORMING TO CAN/CGSB-7.2M, AND WITH 102x150x9.5 (4"x6"x3/8") STL. PLATE TOP & BOTTOM. 910x910x300 (36"x36"x12") CONC. FOOTING ON UNDISTURBED SOIL OR ENGINEERED FILL CAPABLE OF SUSTAINING A PRESSURE OF 100 Kpa. MINIMUM AND AS PER SOILS REPORT.
- 15A.

**STEEL BASEMENT COLUMN (SEE O.B.C. 9.17.3.1, 9.17.3.4)**  
3"x3"x(188) NON-ADJUSTABLE STL. COL. WITH 150x150x9.5 (6"x6"x3/8") STL. TOP & BOTTOM PLATE ON 910x910x300 (36"x36"x12") CONC. FOOTING ON UNDISTURBED SOIL OR ENGINEERED FILL CAPABLE OF SUSTAINING A PRESSURE OF 100 Kpa. MIN. AND AS PER SOILS REPORT.
- 15B.

**STEEL COLUMN (SEE OBC. 9.17.3.1, 9.17.3.4)** 3"x3"x(188) NON-ADJUSTABLE STL. COL. TO BE ON 150x150x9.5 (6"x6"x3/8") STEEL TOP PLATE, & BOTTOM PLATE. BASE PLATE 120x250x12.5 (4'-1/2"x10"x1/2") WITH 2-12mm DIA. x 300mm LONG x50mm HOOK ANCHORS (2-1/2"x12"x2") FIELD WELD COL. TO BASE PLATE.
- 15C.

**STEEL COLUMN (SEE OBC. 9.17.3.1, 9.17.3.4)** 90mm(3'-1/2") DIA.x4.78mm(188) NON-ADJUSTABLE STL. COL. TO BE ON 150x150x9.5 (6"x6"x3/8") STEEL TOP PLATE, & BOTTOM PLATE. BASE PLATE 120x250x12.5 (4'-1/2"x10"x1/2") WITH 2-12mm DIA. x 300mm LONG x50mm HOOK ANCHORS (2-1/2"x12"x2") FIELD WELD COL. TO BASE PLATE.
16.

BEAM POCKET OR 300x150 (12"x6") POURED CONC. NIB WALLS. MIN. BEARING 90mm (3-1/2")
17.

19x64 (1"x3") CONTINUOUS WD. STRAPPING BOTH SIDES OF STEEL BEAM.
18.

**GARAGE SLAB:** 100mm (4") 32MPa (4640psi) CONC. SLAB WITH 5-8% AIR ENTRAINMENT ON OPT. 100 (4") COARSE GRANULAR FILL WITH COMPACTED SUB-BASE OR COMPACTED NATIVE FILL SLOPE TO FRONT AT 1% MIN.
19.

13mm (1/2") GYPSUM BD. ON WALL AND CEILING BETWEEN HOUSE AND GARAGE, RSI 3.87 (R22) IN WALLS, RSI 5.46 (R31) IN CEILING. PROVIDE APPROVED AIR BARRIER. TAPE AND SEAL ALL JOINTS AIR TIGHT.
20.

DOOR AND FRAME GASPROOFED. DOOR EQUIPPED WITH SELF CLOSING DEVICE AND WEATHERSTRIPPING. PER OBC 9.10.13.15
21.

WOOD STEP, C/W HANDRAIL & LANDING IF MORE THAN 3 RISERS, MAX.RISE 200mm (7-7/8") MIN.TREAD 255mm (10-1/16") SEE OBC 9.8.9.2, 9.8.9.3 & 9.8.10
22.

CAPPED DRYER EXHAUST VENTED TO EXTERIOR. (USE 100mm(4") DIA. SMOOTH WALL VENT PIPE) OBC 6.2.3.8.(7)
23.

ATTIC ACCESS HATCH 545x610 (21.5"x24") WITH A MIN. AREA OF 3.44 SF WITH WEATHERSTRIPPING RSI 7.0 (R40) RIGID INSUL. BACKING OBC 9.19.2
24.

**FIREPLACE CHIMNEYS -OBC. 9.21.-** TOP OF FIREPLACE CHIMNEY SHALL BE 915mm (3'-0") ABOVE THE HIGHEST POINT AT WHICH IT COMES IN CONTACT WITH THE ROOF AND 610mm (2'-0") ABOVE THE ROOF SURFACE WITHIN A HORIZ. DISTANCE OF 3050mm (10'-0") FROM THE CHIMNEY.
25.

LINEN CLOSET, 4 SHELVES MIN. 350mm (14") DEEP.
26.

MECHANICAL EXHAUST FAN, VENTED TO EXTERIOR, TO PROVIDE AT LEAST ONE AIR CHANGE PER HOUR.
27.

**STEEL BEARING PLATE FOR MASONRY WALLS** 280x280x16 (11"x11"x5/8") STL. PLATE FOR STL BEAMS AND 280x280x12 (11"x11"x1/2") STL. PLATE FOR WOOD BEAMS BEARING ON CONC. BLOCK PARTYWALL, ANCHORED WITH 2-19mm (3/4") x 200mm (8") LONG GALV. ANCHORS WITHIN SOLID BLOCK COURSE. LEVEL WITH NON-SHRINK GROUT.
28.

U.L.C. RATED CLASS "B" VENT 610mm (2'-0") ABOVE THE POINT IN CONTACT WITH THE ROOF FOR SLOPES UP TO 9/12, REFER TO THE ONTARIO GAS UTILIZATION CODE.
29.

3-38x140 (3-2"x6") BUILT-UP-POST ON METAL BASE SHOE ANCHORED TO CONC. WITH 12.7 DIA. BOLT, 610x610x254 (24"x24"x10") CONC. FTG. OBC 9.17.4
30.

STEP FOOTINGS: MIN. HORIZ. STEP = 600mm (23-5/8"). MAX. VERT. STEP = 600mm (23-5/8") FOR FIRM SOILS.
31.

PORCH SLAB/STEPS: 130 mm (5") MIN. CONC. 32 MPa SLAB AIR ENTRAINMENT MIN. 5 TO 8% AT 28 DAYS, 10 M BARS @ 250 O/C EACH WAY 10M DOWELS @400 (16") O.C. 2-15mm IN THICKENED AREA FROM WALL TO SLAB ALL SIDES (SEE DETAIL)
32.

DIRECT VENT FURNACE TERMINAL MIN. 900mm (36") FROM A GAS REGULATOR. MIN. 300mm (12") ABOVE FIN. GRADE, FROM ALL OPENINGS, EXHAUST AND INTAKE VENTS. HRV INTAKE TO BE A MIN. OF 1830mm (6'-0") FROM ALL EXHAUST TERMINALS. REFER TO GAS UTILIZATION CODE.
33.

DIRECT VENT GAS FIREPLACE. VENT TO BE A MINIMUM 300mm (12") FROM ANY OPENING AND ABOVE FIN. GRADE. REFER TO GAS UTILIZATION CODE.
34.

**SUBFLOOR**  
-19mm (3/4") T & G SUBFLOOR GLUED AND SCREWED TO ENGINEERED FLOOR JOIST SYSTEM. SUPPLY AND INSTALL BLOCKING AND/OR BRIDGING IF INDICATED BY FLOOR JOIST DESIGNER (REFER TO MANUFACTURER'S LAYOUTS AND INSTALLATION INSTRUCTIONS)
35.

**EXPOSED BUILDING FACE -OBC. 9.10.14.5-** EXTERIOR WALLS TO HAVE A FIRE RESISTANCE RATING OF NOT LESS THAN 45 min. WHERE LIMITING DISTANCE IS LESS THAN 1.2M (3'-11"). WHERE THE LIMITING DISTANCE IS LESS THAN 600mm (1'-11") THE EXPOSING FACE SHALL BE CLAD IN NON-COMBUSTIBLE MATERIAL.
36.

**LINTEL SPECIFICATION**  
ALL WINDOW AND DOOR LINTELS TO BE COMPRISED OF 2-2X10 BUILT-UP WOOD BEAM, EACH END BEARING ON P2s (UNLESS NOTED OTHERWISE)
37.

THE FDTN. WALL SHALL NOT BE REDUCED TO LESS THAN 90mm (3 11/16") THICK TO A MAX. DEPTH OF 350mm (13 3/4") AND SHALL BE TIED TO THE FACING MATERIAL WITH METAL TIES SPACED 200mm (8") O.C. VERTICALLY AND 900mm (36") O.C. HORIZONTALLY. FILL SPACE BETWEEN WALL AND FACING SOLID WITH MORTAR. (SEE OBC 9.15.4.7)

38.

**CONVENTIONAL ROOF FRAMING** 38x140 (2"x6") RAFTERS @ 400mm (16"O.C.), FOR MAX. 11'-7" SPAN. 38x184 (2"x8") RIDGE BOARD. 38x89 (2"x4") COLLAR TIES AT MIDSPANS. CEILING JOISTS TO BE 38x89 (2"x4") @ 400mm (16") O.C. FOR MAX. 2830mm (9'-3") SPAN & 38x140 (2"x6") @ 400mm (16") O.C. FOR MAX. 4450mm (14'-7") SPAN. RAFTERS FOR BUILT-UP ROOF TO BE 38x89 (2"x4") @ 600mm (24") O.C. WITH A 38x89 (2"x4") CENTRE POST TO THE TRUSS BELOW, LATERALLY BRACED AT 1800mm (6'-0") O.C. VERTICALLY.
39.

**TWO STOREY VOLUME SPACES**  
FOR HIGH WALL UP TO 18'-0": CONSTRUCTION: 2"x6" SPACING AS INDICATED BLOCKING: 3 ROWS @ 4'-6" O/C ± SHEATHING: 7/16" ASPENITE NAILING: 2" STAPLES BET. 4" AND 6" O/C ALONG STUDS  
**TALL WALL FRAMING TO COMPLY WITH OBC 9.23.10.**  
STUD SPACING WITH VARIOUS FINISHES:  
1. SIDING-METAL OR VINYL- 2"x6" @12" O/C  
2. STUCCO -2"x6" @16" O/C  
3. BRICK TO 4'-0" -2"x6" @16" O/C  
4. BRICK FULL HEIGHT -2-2"x6" @12" O/C
40.

TYPICAL 1 HOUR RATED PARTYWALL. REFER TO DETAILS FOR TYPE AND SPECIFICATIONS.

41.

**STRIP FOOTING SUPPORTING EXTERIOR WALLS**  
-SEE OBC 9.15.3.  
-ASSUMING MASONRY VENEER CONSTRUCTION, MAX. FLOOR LIVE LOAD OF 2.4kPa. (50psf.) PER FLOOR, AND MAX. LENGTH OF SUPPORTED FLOOR JOISTS IS 4.9m (16'-1"). THE STRIP FOOTING SIZE IS AS FOLLOWS:  
2 STOREY ( STANDARD ) 500x155 (20"x6")  
2 STOREY ( WALK-OUT BASEMENT ) 545x175 (22"x7") (UNLESS OTHERWISE NOTED ON PLAN)
42.

**EXTERIOR WALLS FOR WALK-OUT CONDITIONS** THE EXTERIOR BASEMENT STUD WALL TO BE 38x140 (2"x6") STUDS @ 16" o.c. OR 38x89 (2"x4") STUDS @ 12"o.c.
43.

**FLASHING FOR EXT. WALL OPENINGS (O.B.C.9.27.3.8.(3)**
44.

**SUMP PITS (WHERE REQ'D) SEE O.B.C. 9.14.5.2**  
-MUST BE SEALED AS PER 9.25.3.3.(16)
- CERTIFIED PERMIT DOCUMENT

A copy of the permit plans & documents shall be kept & maintained on site and made available to an inspector upon request.

2023-07-06
- WINDOWS:

1

MINIMUM BEDROOM WINDOW -OBC. 9.9.10. AT LEAST ONE BEDROOM WINDOW ON A GIVEN FLOOR IS TO HAVE MIN. 0.35m2 UNOBSTRUCTED GUARDED OR OPENABLE AREA WITH MIN. CLEAR WIDTH OF 380 mm (1'-3").

2

WINDOW GUARDS -OBC. 9.8.8.1. A GLAZED IS REQUIRED WHERE THE TOP OF THE WINDOW SILL IS LOCATED LESS THAN 480mm (1'-7") ABOVE FIN. FLOOR AND THE DISTANCE FROM THE FIN. FLOOR TO THE ADJACENT GRADE IS GREATER THAN 1800mm (5'-11")

3

ALL WINDOWS TO COMPLY WITH THERMAL RESISTANCE REQUIREMENTS STATED IN OBC 12.3.2.6. AND SB12 PRESCRIPTIVE COMPLIANCE PACKAGE, AND OBC 9.5, 9.6, 9.7

GENERAL

1

MECHANICAL VENTILATION IS REQUIRED TO PROVIDE 0.3 AIR CHANGES PER HOUR AVERAGED OVER 24 HOURS. SEE MECHANICAL DRAWINGS.

2

ALL DOWNSPOUTS TO DRAIN AWAY FROM THE BUILDINGAS PER OBC 9.26.18.2 AND MUN. STANDARDS.

3

ALL WINDOW WELLS TO DRAIN TO FOOTING LEVEL PER OBC 9.14.6.3 CHECK WITH LOCAL AUTHORITY.

4

PROVIDE STUD WALL REINFORCEMENT FOR FUTURE GRAB BARS IN BATHROOMS. REINF. OF STUD WALLS SHALL BE INSTALLED ADJACENT TO WATER CLOSETS AND SHOWER OR BATHTUB IN MAIN BATHROOM, SEE OBC 9.5.2.3.

LUMBER:

1

ALL LUMBER SHALL BE SPRUCE NO.2 GRADE, UNLESS NOTED OTHERWISE.

2

STUDS SHALL BE STUD GRADE SPRUCE, UNLESS NOTED OTHERWISE.

3

LUMBER EXPOSED TO THE EXTERIOR TO BE SPRUCE No.2 GRADE PRESSURE TREATED OR CEDAR, UNLESS NOTED OTHERWISE.

4

ALL LAMINATED VENEER LUMBER (L.V.L.) BEAMS, GIRDER TRUSSES, AND METAL HANGER CONNECTIONS SUPPORTING ROOF FRAMING TO BE DESIGNED & CERTIFIED BY TRUSS MANUF.

5

LVL BEAMS SHALL BE 2.0E WS MICRO-LAM LVL (Fb=2800psi.MIN.) OR EQUIVALENT. NAIL EACH PLY OF LVL WITH 89mm (3 1/2") LONG COMMON WIRE NAILS @ 300mm (12") O.C. STAGGERED IN 2 ROWS FOR 184, 240 & 300mm (7 1/4",9 1/2", 11 7/8") DEPTHS AND STAGGERED IN 3 ROWS FOR GREATER DEPTHS AND FOR 4 PLY MEMBERS ADD 13mm (1/2") DIA. GALVANIZED BOLTS BOLTED AT MID-DEPTH OF BEAM @ 915mm (3'-0") O.C.

6

PROVIDE TOP MOUNT BEAM HANGERS TYPE "SCL" MANUFACTURED BY MGA CONNECTOR LTD. Tel. (905) 642-3175 OR EQUAL FOR ALL LVL BEAM TO BEAM CONNECTIONS UNLESS OTHERWISE NOTED.

7

JOIST HANGERS: PROVIDE METAL HANGERS FOR ALL JOISTS AND BUILT-UP WOOD MEMBERS INTERSECTING FLUSH BUILT-UP WOOD MEMBERS.

8

WOOD FRAMING NOT TREATED WITH A WOOD PRESERVATIVE, IN CONTACT WITH CONCRETE, SHALL BE SEPARATED FROM THE CONCRETE BY AT LEAST 2 mil. POLYETHYLENE FILM, No. 50 (45lbs.) ROLL ROOFING OR OTHER DAMPPROOFING MATERIAL, EXCEPT WHERE THE WOOD MEMBER IS ST LEAST 150mm (6") ABOVE THE GROUND.

STEEL:

1

STRUCTURAL STEEL SHALL CONFORM TO CAN/CSA-G40-21 GRADE 300W. HOLLOW STRUCTURAL SECTIONS SHALL CONFORM TO CAN/CSA-G40-21 GRADE 350W CLASS "H".

2

REINFORCING STEEL SHALL CONFORM TO CSA-G30-18M GRADE 400R.
- WOOD LINTELS AND BUILT-UP WOOD BEAMS
- |    |                                |
|----|--------------------------------|
| L1 | 2/38 x 184 (2/2" x 8") SPR.#2  |
| B1 | 3/38 x 184 (3/2" x 8") SPR.#2  |
| B2 | 4/38 x 184 (4/2" x 8") SPR.#2  |
| L3 | 2/38 x 235 (2/2" x 10") SPR.#2 |
| B3 | 3/38 x 235 (3/2" x 10") SPR.#2 |
| B4 | 4/38 x 235 (4/2" x 10") SPR.#2 |
| L5 | 2/38 x 286 (2/2" x 12") SPR.#2 |
| B5 | 3/38 x 286 (3/2" x 12") SPR.#2 |
| B6 | 4/38 x 286 (4/2" x 12") SPR.#2 |
- LAMINATED VENEER LUMBER (LVL) BEAMS
- |      |                             |
|------|-----------------------------|
| LVL1 | 2-1 3/4"x7 1/4" (2-45x184)  |
| LVL2 | 3-1 3/4"x7 1/4" (3-45x184)  |
| LVL3 | 4-1 3/4"x7 1/4" (4-45x184)  |
| LVL4 | 2-1 3/4"x9 1/2" (2-45x240)  |
| LVL5 | 3-1 3/4"x9 1/2" (3-45x240)  |
| LVL6 | 2-1 3/4"x11 7/8" (2-45x300) |
| LVL7 | 3-1 3/4"x11 7/8" (3-45x300) |
- LOOSE STEEL LINTELS
- |     |   |
|-----|---|
| L7  | 90 x 90 x 6.0L (3-1/2" x 3-1/2" x 1/4"L)  |
| L8  | 90 x 90 x 8.0L (3-1/2" x 3-1/2" x 5/16"L) |
| L9  | 100 x 90 x 8.0L (4" x 3-1/2" x 5/16"L)    |
| L10 | 125 x 90 x 8.0L (5" x 3-1/2" x 5/16"L)    |
| L11 | 125 x 90 x 10.0L (5" x 3-1/2" x 3/8"L)    |
| L12 | 150 x 100 x 10.0L (6"x 4" x 3/8"L)        |
- STEEL COLUMNS (UNLESS NOTED OTHERWISE)
- TP = (1) 3" DIA. ADJ. ST. POST  
2TP = (2) 3" DIA. ADJ. ST. POSTS  
HSS = 3.5"x3.5" HOLLOW STRUCTURAL SECTION STEEL POST
- | MASONRY VENEER LINTEL SCHEDULE [OBC2012]<br>PROVIDE 6"MINIMUM BEARING EACH END 9.20.5.2B |                        |
|--|------------------------|
| OPENINGS   | LINTEL SIZE            |
| UP TO 8'-0"  | 3 1\2" x 3 1\2" x 1/4" |
| 8'-0" TO 8'-8"   | 4" x 3 1\2" x 1/4"     |
| 8'-8" TO 10'-10"   | 5" x 3 1\2" x 5/16"    |
| 10'-10" TO 11'-5"  | 5" x 3 1\2" x 7/16"    |
| 11'-5" TO 11'-9"   | 5" x 3 1\2" x 1/2"     |
| 11'-9" TO 12'-6"   | 6" x 3 1/2" x 7/16"    |
| 12'-6" TO 13'-4"   | 6" x 3 1/2" x 1/2"     |
- LEGEND
- EXHAUST VENT

DUPLEX OUTLET (12" HIGH)

WEATHERPROOF DUPLEX OUTLET

HEAVY DUTY OUTLET

POT LIGHT

LIGHT FIXTURE (CEILING MOUNTED)

LIGHT FIXTURE (WALL MOUNTED)

SWITCH

SWITCH (3-WAY)

FLOOR DRAIN

HOSE BIB

DOUBLE JOIST

LVL LAMINATED VENEER LUMBER

POINT LOAD FROM ABOVE

P.T. PRESSURE TREATED LUMBER

G.T. GIRDER TRUSS BY ROOF TRUSS MANUF.

F.A. FLAT ARCH

C.A. CURVED ARCH
- M.C. MEDICINE CABINET

DOUBLE VOLUME WALL SEE NOTE 39.

SOLID WOOD BEARING  
  
P2 - 2 MEMBER BUILT-UP STUD  
P3 - 3 MEMBER BUILT-UP STUD  
P4 - 4 MEMBER BUILT-UP STUD  
P5 - 5 MEMBER BUILT-UP STUD


**SMOKE ALARM (AUDIBLE/VISUAL)-OBC 9.10.19.**  
PROVIDE 1 PER FLOOR, NEAR THE STAIRS CONNECTING THE FLOOR LEVEL. ONE PER SLEEPING ROOM, INCLUDING HALLWAYS BE CONNECTED TO AN ELECTRICAL CIRCUIT AND INTERCONNECTED TO ACTIVATE ALL ALARMS WHEN ONE ALARM SOUNDS.  
-9.10.19.1(2) REQUIRED SMOKE ALARMS TO HAVE A VISUAL COMPONENT

**CARBON MONOXIDE ALARM (OBC 9.33.4)**  
WHERE A FUEL-BURNING APPLIANCE IS INSTALLED IN A DWELLING UNIT, A CARBON MONOXIDE ALARM CONFORMING TO CAN/CSA-6.19, CSA 6.19 OR UL2034 SHALL BE INSTALLED ADJACENT TO EACH SLEEPING AREA. CARBON MONOXIDE ALARM(S) SHALL BE PERMANENTLY WIRED SO THAT ITS ACTIVATION WILL ACTIVATE ALL CARBON MONOXIDE ALARMS AND BE EQUIPPED WITH AN ALARM THAT IS AUDIBLE WITHIN BEDROOMS WHEN THE INTERVENING DOORS ARE CLOSED.  
  
**SOIL GAS CONTROL (OBC 9.13.1. & 9.13.4, & SB9)** PROVIDE CONSTRUCTION TO PREVENT LEAKAGE OF SOIL GAS INTO THE BUILDING WHERE REQUIRED. (SEE ALSO O.B.C. 9.1.1.7.(1)

CONTRACTOR MUST VERIFY ALL DIMENSIONS ON THE JOB AND REPORT ANY DISCREPANCY TO THE BUILDER BEFORE PROCEEDING WITH THE WORK. DO NOT SCALE DRAWINGS, USE DIMENSIONS PROVIDED. ALL DRAWINGS TO BE USED FOR CONSTRUCTION ONLY AFTER BUILDING PERMIT HAS BEEN ISSUED.
- 
- BIRCHWOOD LOFT C -2022
- SITE: WHITETAIL RIDGE PHASE 4
- LOT NUMBER:
- CIVIC ADDRESS:  
168 FRANK FISHER CRESCENT
- 118
- |           |                        |          |    |
|-----------|------------------------|----------|----|
| 7         | CIVC ADDRESS CHANGE    | 08/05/23 | CB |
| 6         | ISSUED FOR ENGINEERING | 02/05/23 | CB |
| 5         | ISSUED FOR LAYOUTS     | 18/04/23 | CB |
| 4         | BEP BLACKLINES         | 29/03/23 | CB |
| 3         | PRELIM BLACKLINES      | 03/03/23 | CB |
| 2         | FOR REVISED LAYOUTS    | 13/01/23 | SP |
| No.       | Description            | dd/mm/yy | By |
| REVISIONS |                        |          |    |
- footprint: 50-22-3-C
- drawn by: SP
- date: JAN 13/16
- scale: 3/16"=1'-0"
- D.C.L: 202
- sheet no:
- 1 of  
9



**\*\*REQUIRED FOR WINDOWS OVER 47" WIDE\*\***  
O.B.C. 9.15.4.3  
ADD 2-15M HORIZONTAL BARS BELOW WINDOW  
EXTENDING 2'-0" BEYOND EDGE OF OPENING &  
2-15M VERTICAL BARS EACH SIDE

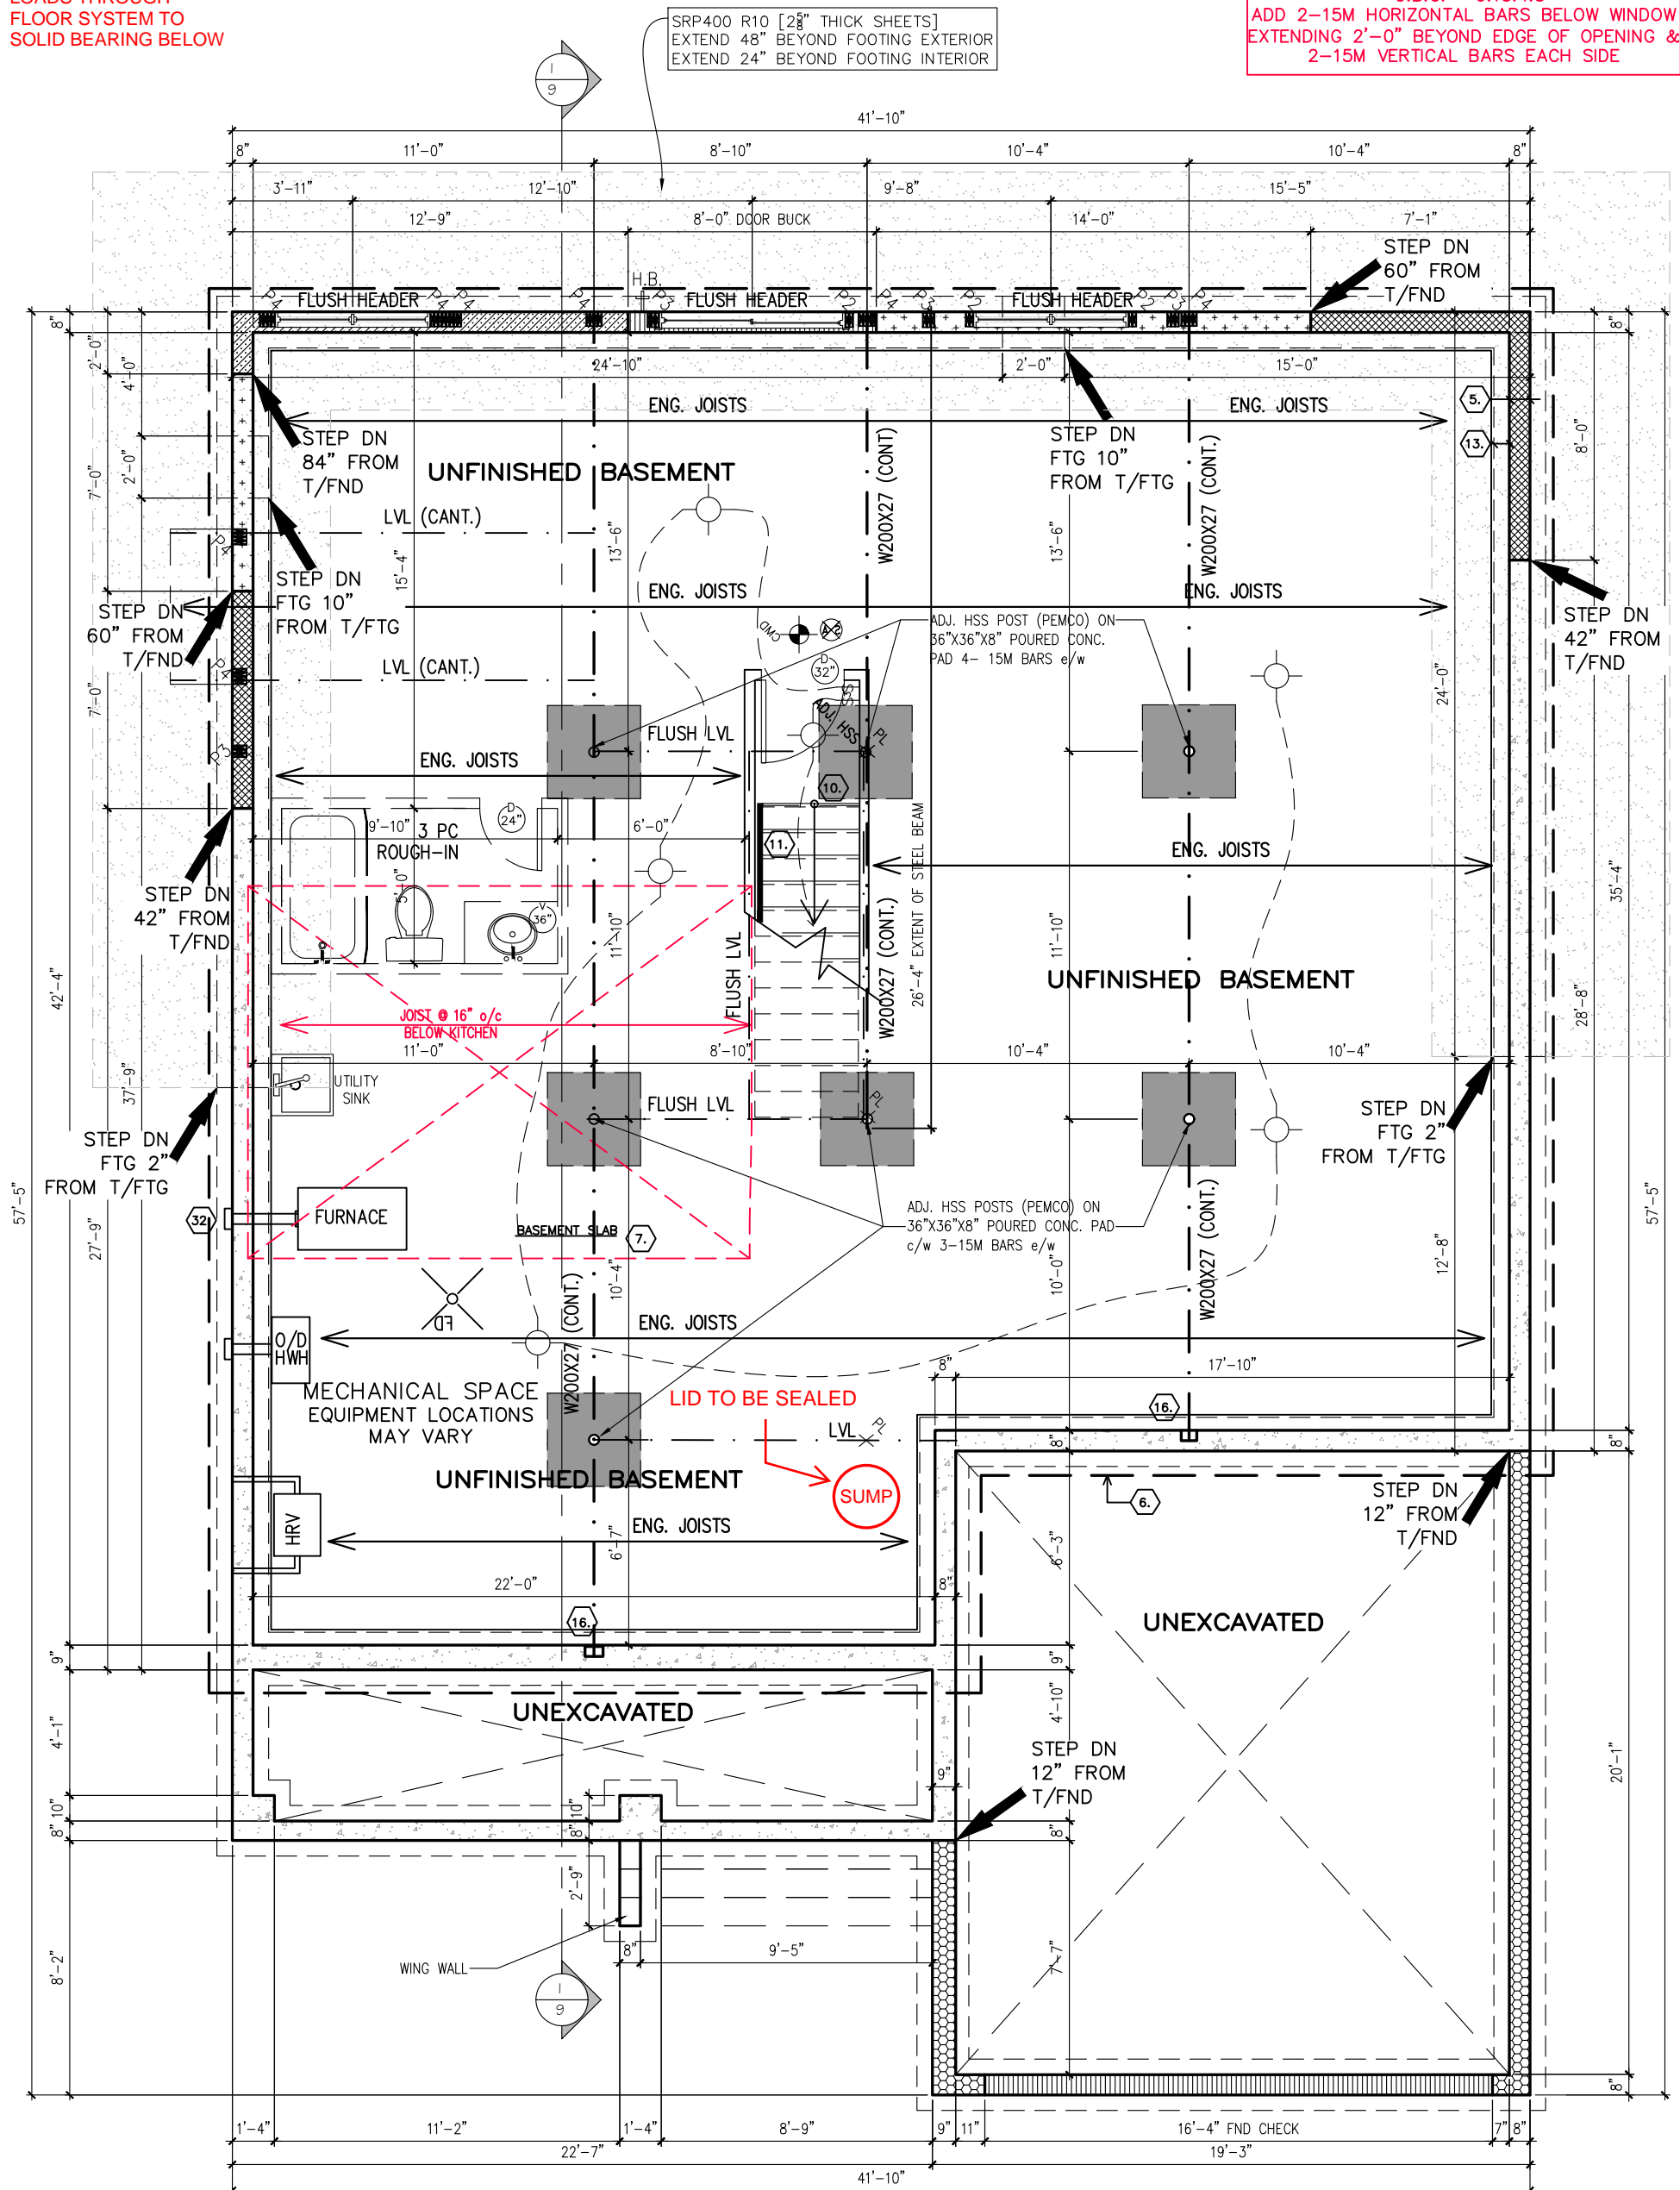


HOUSE STATISTICS	
ELEVATION= C	BEDROOMS= 4
SQ. FT. GROUND FLR = 1703	
SQ. FT. SECOND FLR = 587	
TOTAL = 2303 (inc. basement)	
SQ. FT. BASEMENT = 13	
SQ. FT. FRONT PORCH = 134	
SQ. FT. DECK = 0	

BASEMENT PLAN WITH LOFT  
ELEVATION C  
13 SQ FT

**CERTIFIED PERMIT DOCUMENT**

A copy of the permit plans & documents shall be kept & maintained on site and made available to an inspector upon request.



PHOENIX HOMES

BIRCHWOOD LOFT C -2022

SITE: WHITETAIL RIDGE PHASE 4

LOT NUMBER:

CIVIC ADDRESS:  
168 FRANK FISHER CRESCENT

118

7	CIVIC ADDRESS CHANGE	08/05/23	CB
6	ISSUED FOR ENGINEERING	02/05/23	CB
5	ISSUED FOR LAYOUTS	18/04/23	CB
4	BEP BLACKLINES	29/03/23	CB
3	PRELIM BLACKLINES	03/03/23	CB
2	FOR REVISED LAYOUTS	13/01/23	SP
No.	Description	dd/mm/yy	By
REVISIONS			

footprint: 50-22-3-C

drawn by: SP

date: JAN 13/16

scale:  $3/16"=1'-0"$


D.C.L: 202

sheet no:

$$\frac{2C}{9}$$

CONTRACTOR MUST VERIFY ALL DIMENSIONS ON THE JOB AND REPORT ANY DISCREPANCY TO DCR/PHOENIX BEFORE PROCEEDING WITH THE WORK.  
ALL DRAWINGS AND SPECIFICATIONS ARE INSTRUMENTS OF SERVICE AND THE PROPERTY OF THE DCR/PHOENIX WHICH MUST BE RETURNED AT THE COMPLETION OF THE WORK.  
ALL DRAWINGS TO BE USED FOR CONSTRUCTION ONLY AFTER BUILDING PERMIT HAS BEEN ISSUED.  
DO NOT SCALE DRAWINGS, USE DIMENSIONS PROVIDED.

**\*\*NOTE\*\***  
ALL WINDOW LINTELS TO BE 2-2X10  
W/ P2 POSTS ON EACH SIDE U.N.O.

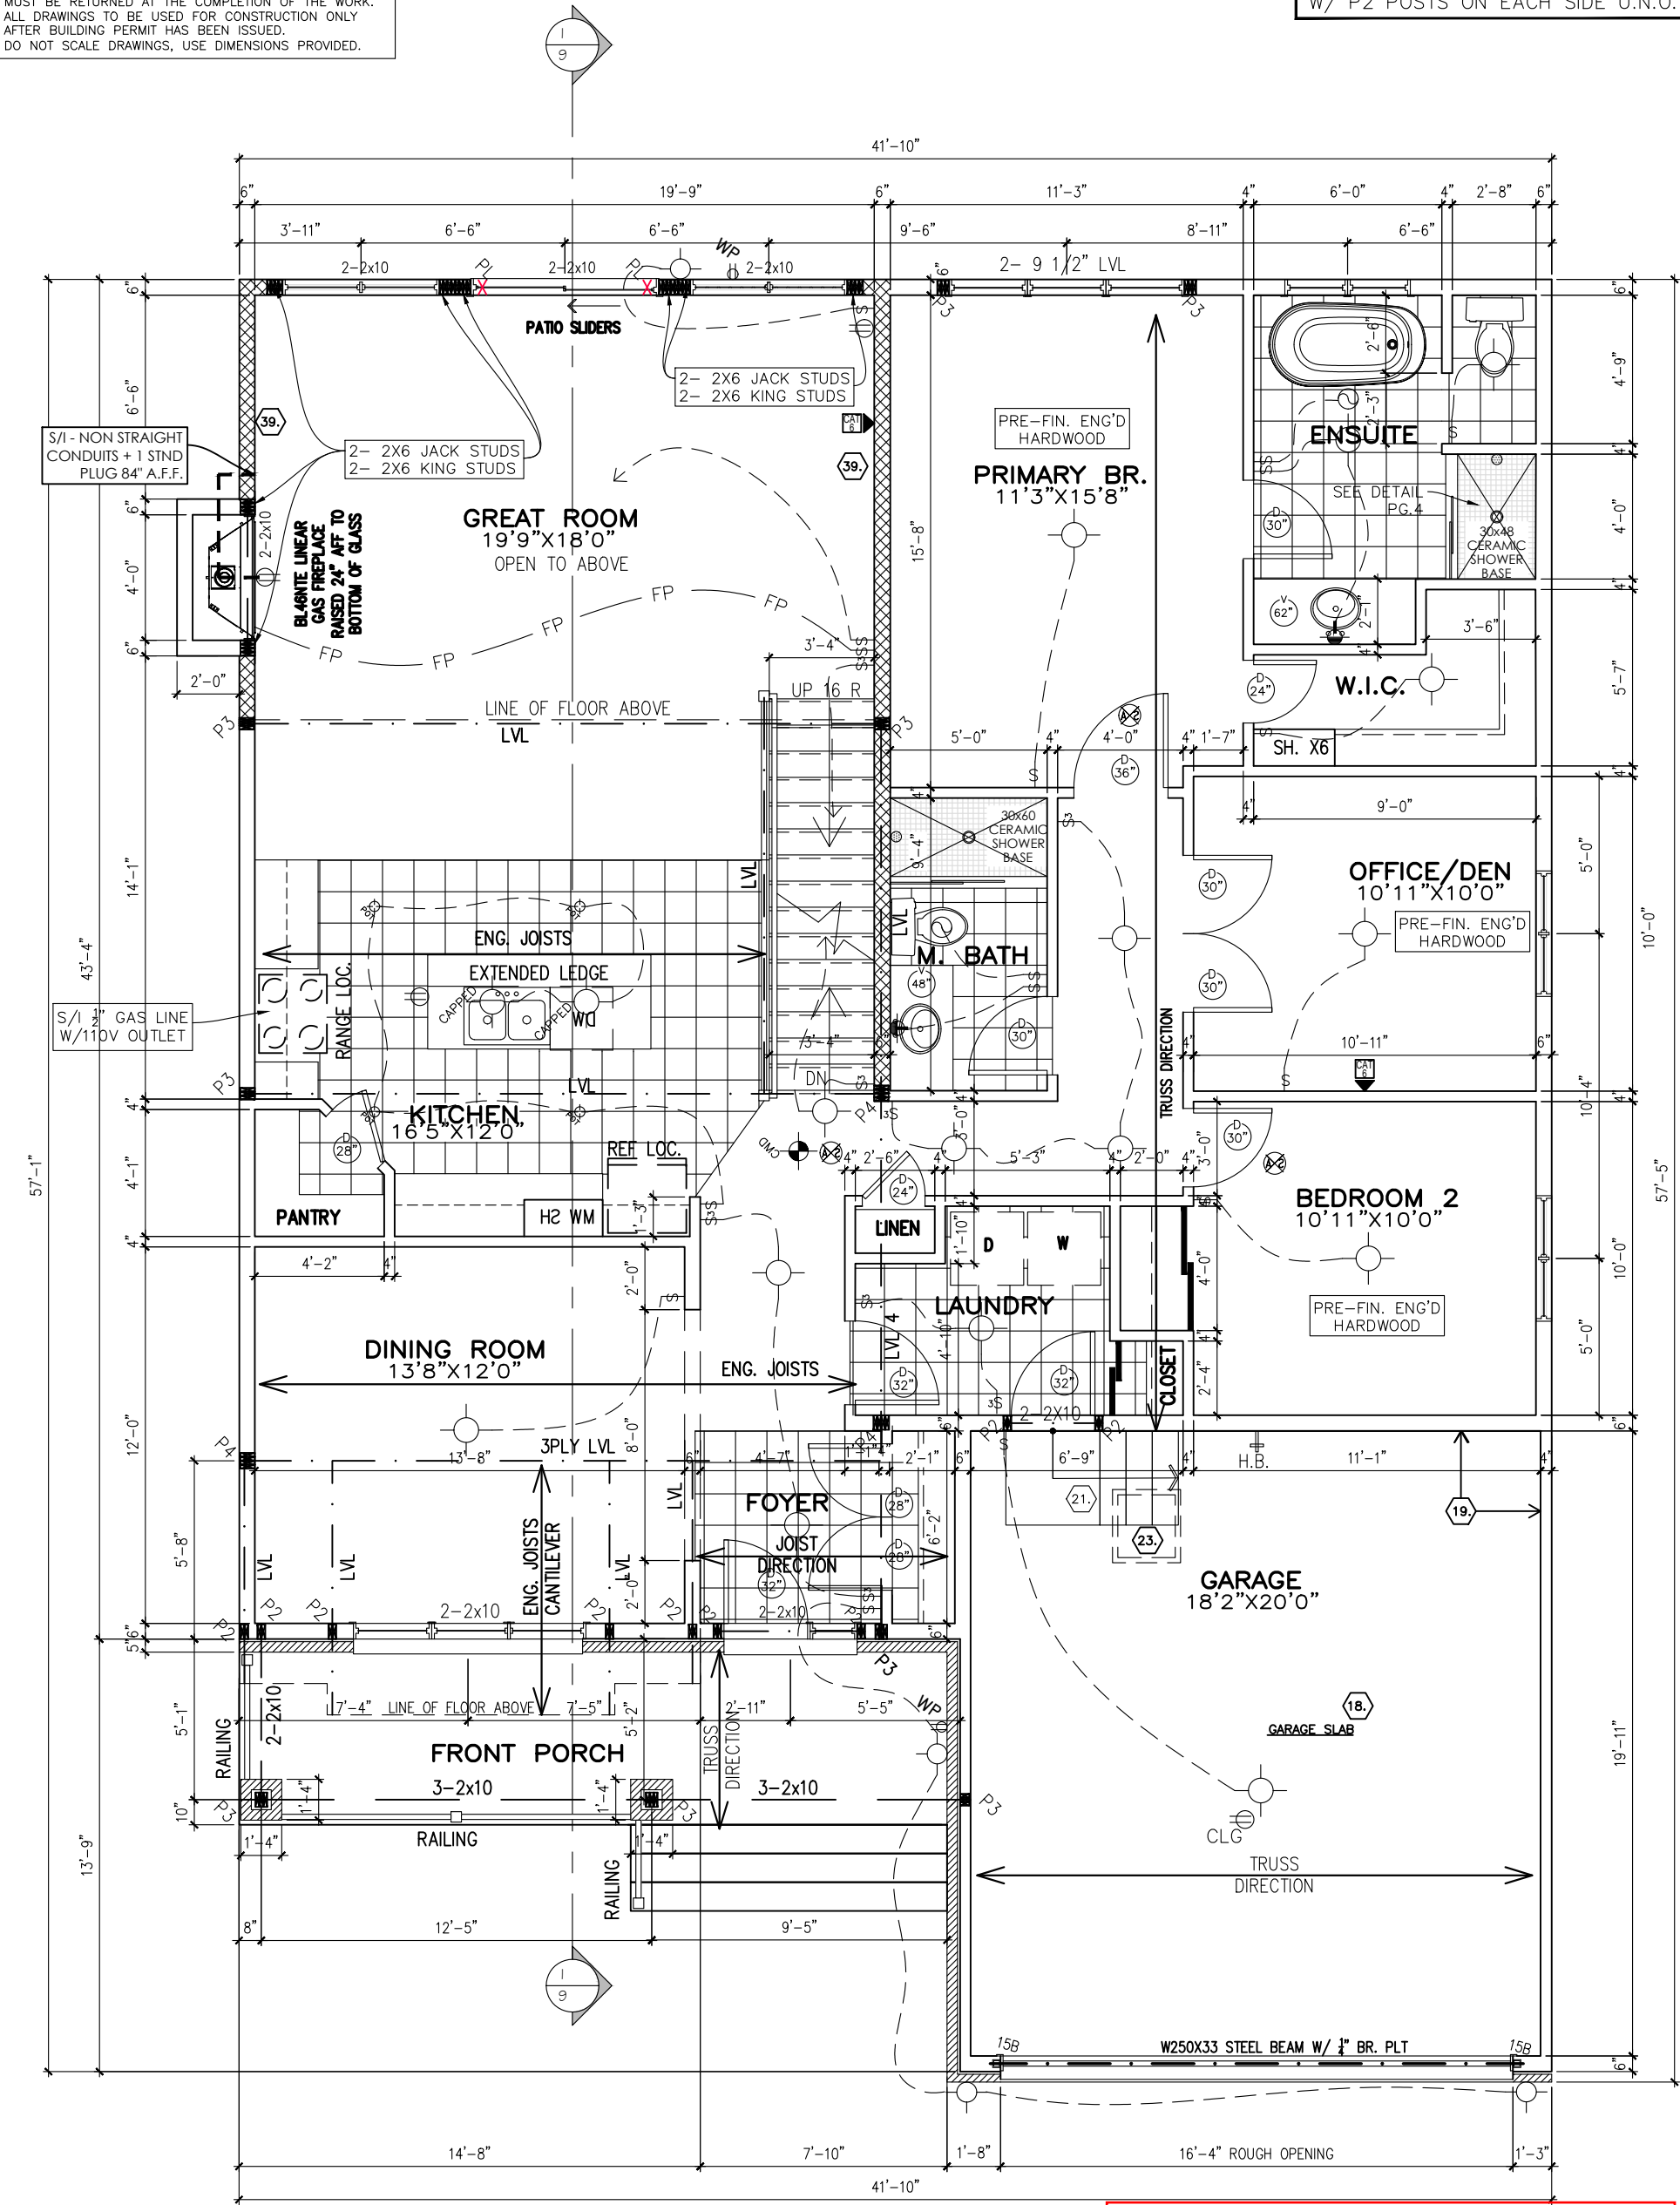

GROUND FLOOR  
ELEVATION C  
1689 SQ FT

**CERTIFIED PERMIT DOCUMENT**  
A copy of the permit plans & documents shall be kept & maintained on site and made available to an inspector upon request.  
2023-07-06



BIRCHWOOD LOFT C - 2022  
SITE: WHITETAIL RIDGE PHASE 4  
LOT NUMBER: 118  
CIVIC ADDRESS: 168 FRANK FISHER CRESCENT


7	CIVIC ADDRESS CHANGE	08/05/23	CB
6	ISSUED FOR ENGINEERING	02/05/23	CB
5	ISSUED FOR LAYOUTS	18/04/23	CB
4	BEP BLACKLINES	29/03/23	CB
3	PRELIM BLACKLINES	03/03/23	CB
2	FOR REVISED LAYOUTS	13/01/23	SP
No.	Description	dd/mm/yy	By
REVISIONS			

footprint: 50-22-3-C	
drawn by:	SP
date:	JAN 13/16
scale:	3/16"=1'-0"
D.C.L:	202
sheet no:	3C of 9



CONTRACTOR MUST VERIFY ALL DIMENSIONS ON THE JOB AND REPORT ANY DISCREPANCY TO DCR/PHOENIX BEFORE PROCEEDING WITH THE WORK.  
ALL DRAWINGS AND SPECIFICATIONS ARE INSTRUMENTS OF SERVICE AND THE PROPERTY OF THE DCR/PHOENIX WHICH MUST BE RETURNED AT THE COMPLETION OF THE WORK.  
ALL DRAWINGS TO BE USED FOR CONSTRUCTION ONLY AFTER BUILDING PERMIT HAS BEEN ISSUED.  
DO NOT SCALE DRAWINGS, USE DIMENSIONS PROVIDED.

**\*\*NOTE\*\***  
ALL WINDOW LINTELS TO BE 2-2X10  
W/ P2 POSTS ON EACH SIDE U.N.O.

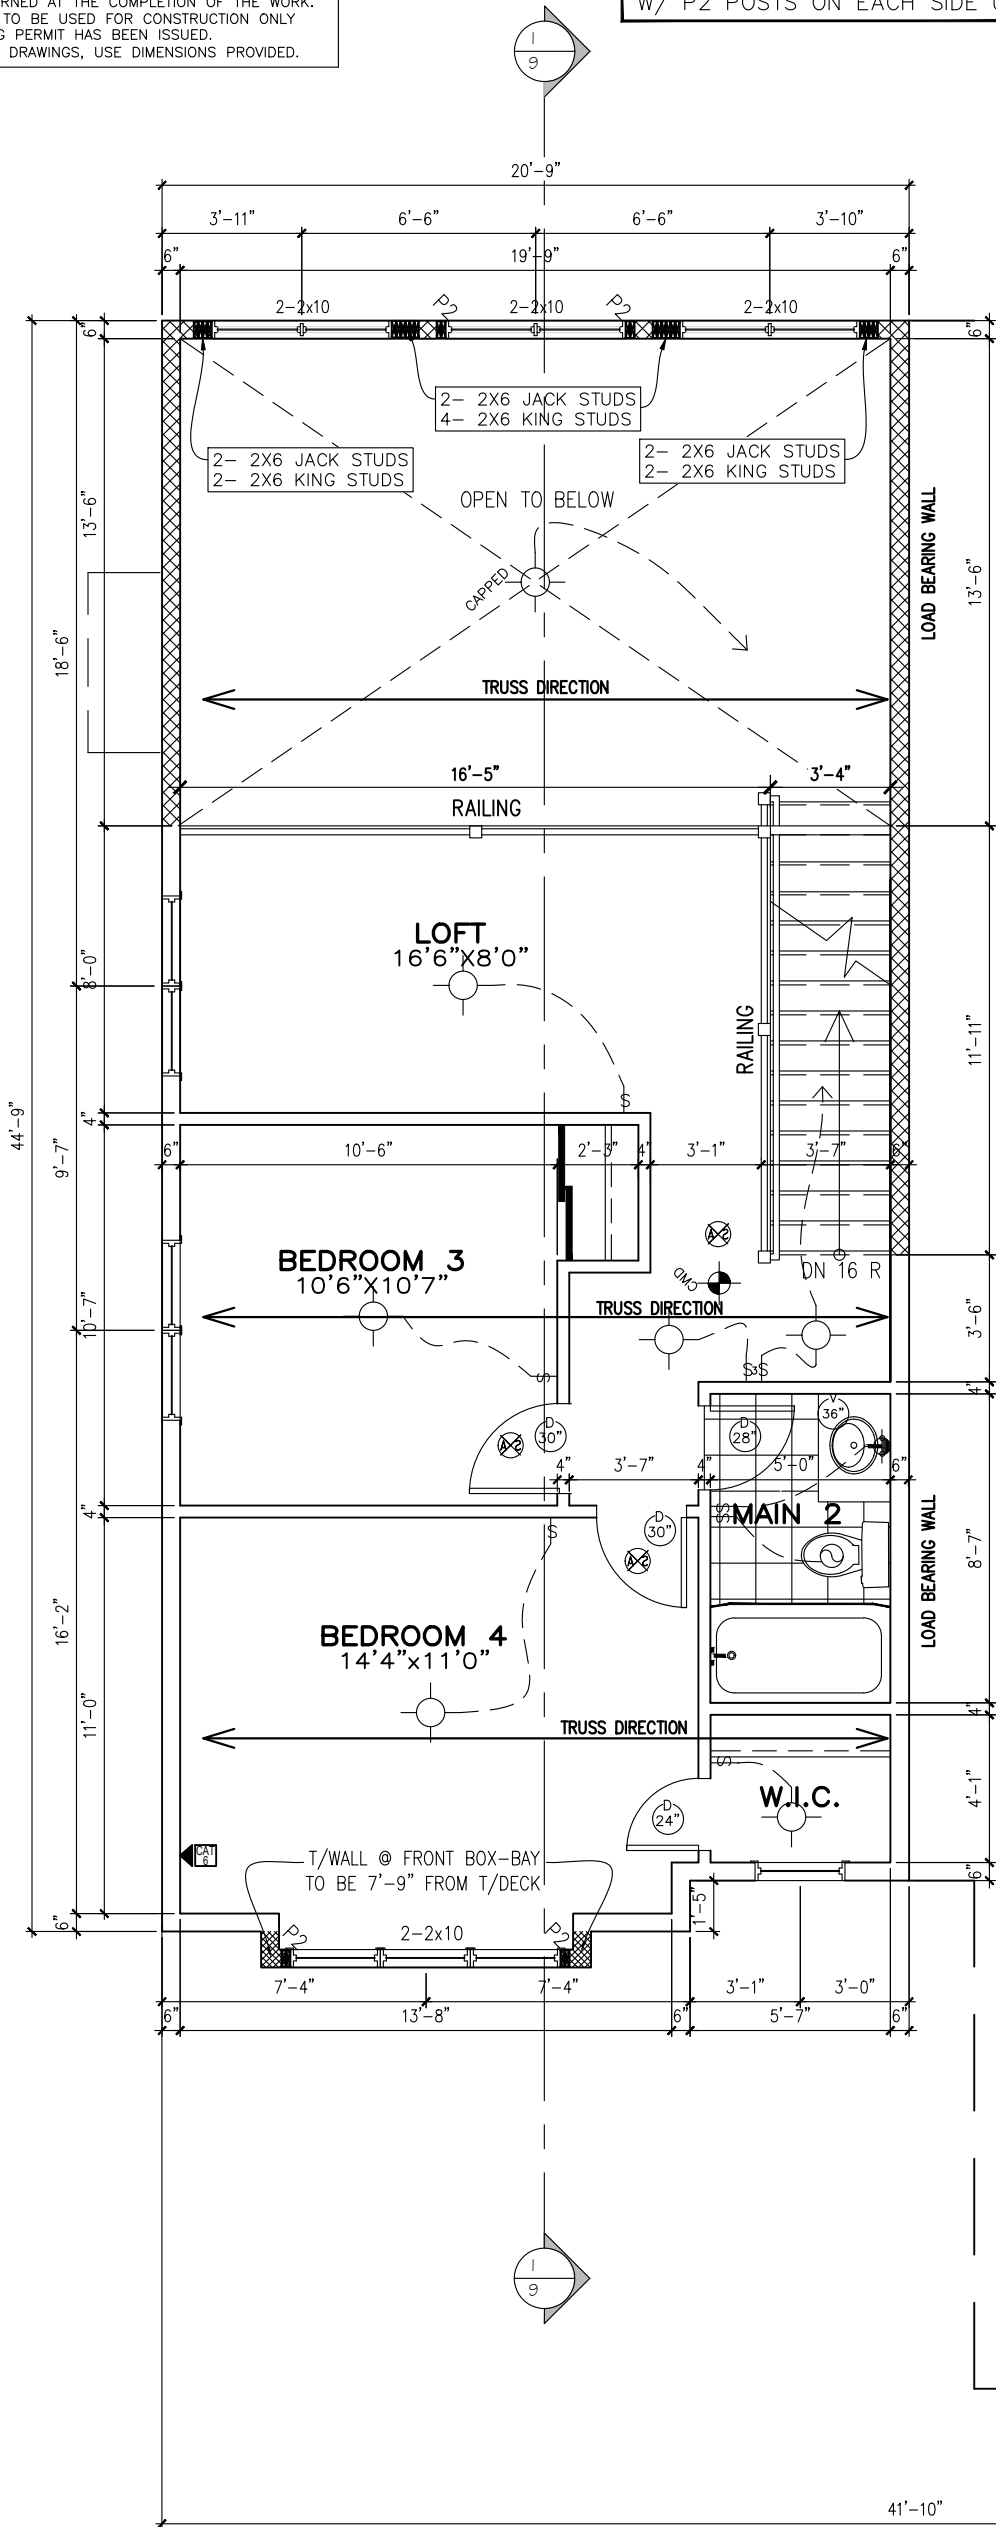


SECOND FLOOR PLAN  
ELEVATION C  
661 SQ FT

**CERTIFIED PERMIT DOCUMENT**

A copy of the permit plans & documents shall be kept & maintained on site and made available to an inspector upon request.

2023-07-06



PHOENIX HOMES

BIRCHWOOD LOFT C -2022

SITE: WHITETAIL RIDGE PHASE 4

LOT NUMBER:

118

CIVIC ADDRESS:  
168 FRANK FISHER CRESCENT


7	CIVIC ADDRESS CHANGE	08/05/23	CB
6	ISSUED FOR ENGINEERING	02/05/23	CB
5	ISSUED FOR LAYOUTS	18/04/23	CB
4	BEP BLACKLINES	29/03/23	CB
3	PRELIM BLACKLINES	03/03/23	CB
2	FOR REVISED LAYOUTS	13/01/23	SP
No.	Description	dd/mm/yy	By
REVISIONS			

footprint: 50-22-3-C	
drawn by:	SP
date:	JAN 13/16
scale:	3/16"=1'-0"
D.C.L: 202	4C of 9
sheet no:	


CERTIFIED PERMIT DOCUMENT

A copy of the permit plans & documents shall be kept & maintained on site and made available to an inspector upon request.

2023-07-06

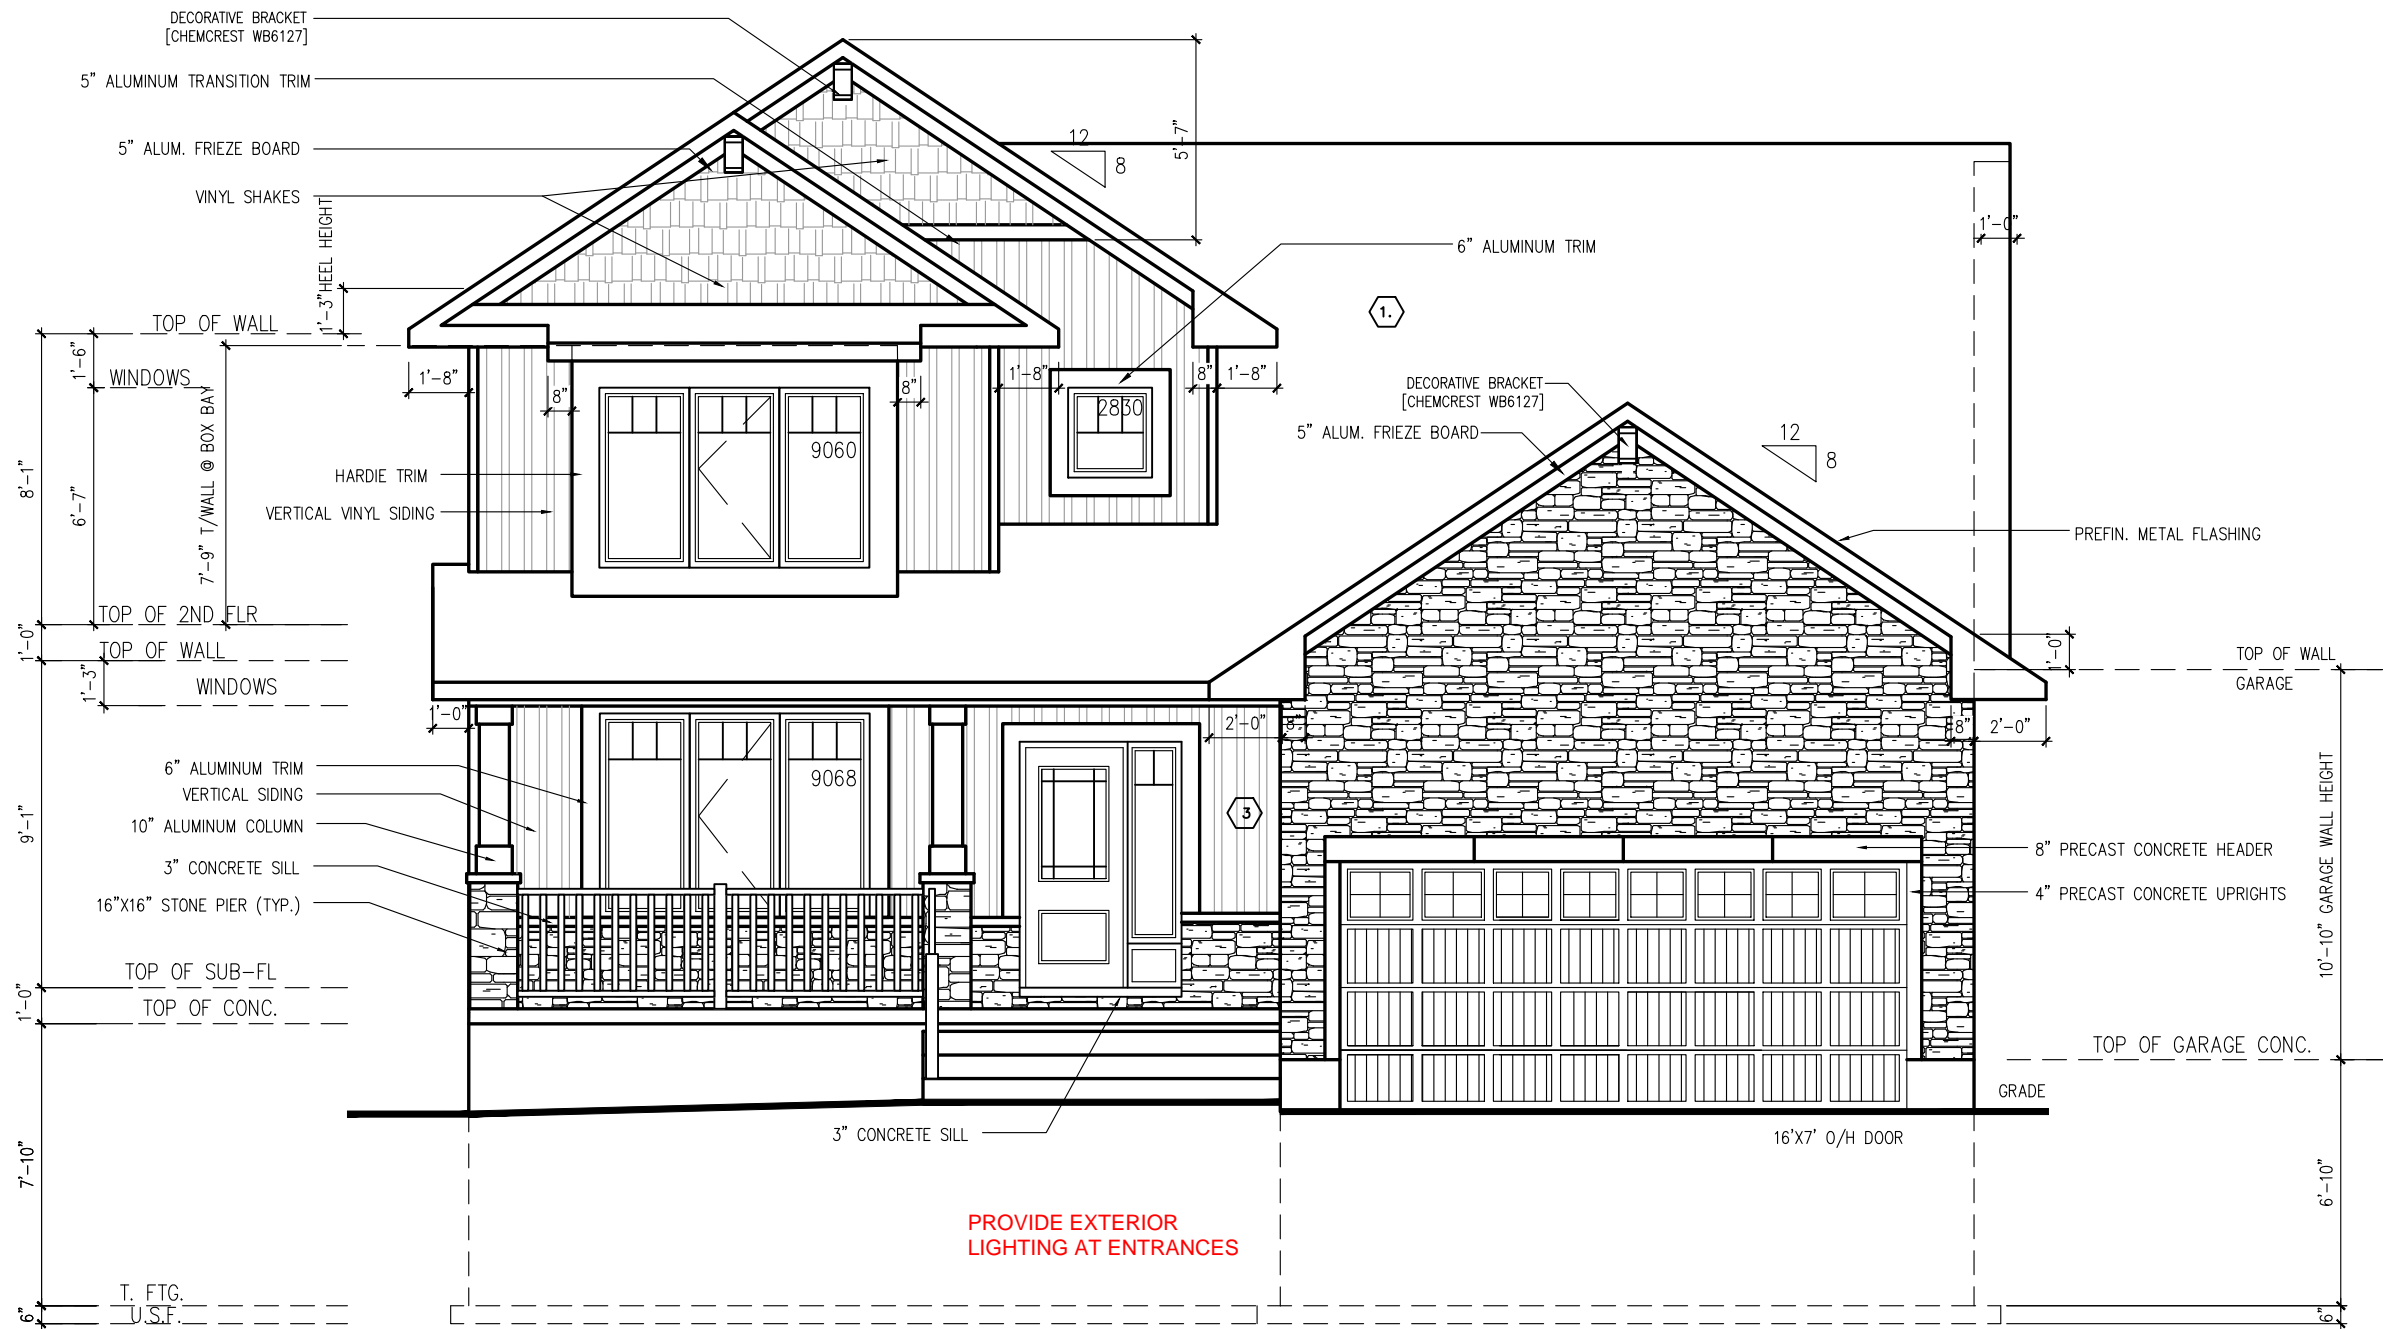

FRONT ELEVATION C



PHOENIX HOMES

BIRCHWOOD LOFT C -2022

SITE: WHITETAIL RIDGE PHASE 4

LOT NUMBER:

118

CIVIC ADDRESS:  
168 FRANK FISHER CRESCENT

7	CIVIC ADDRESS CHANGE	08/05/23	CB
6	ISSUED FOR ENGINEERING	02/05/23	CB
5	ISSUED FOR LAYOUTS	18/04/23	CB
4	BEP BLACKLINES	29/03/23	CB
3	PRELIM BLACKLINES	03/03/23	CB
2	FOR REVISED LAYOUTS	13/01/23	SP
No.	Description	dd/mm/yy	By
REVISIONS			

footprint: 50-22-3-0

drawn by: SP

date: JAN 13/16

scale: 3/16"=1'-0"

D.C.L: 202

sheet no:


5C of  
9



CERTIFIED PERMIT DOCUMENT

A copy of the permit plans & documents shall be kept & maintained on site and made available to an inspector upon request.

2023-07-06

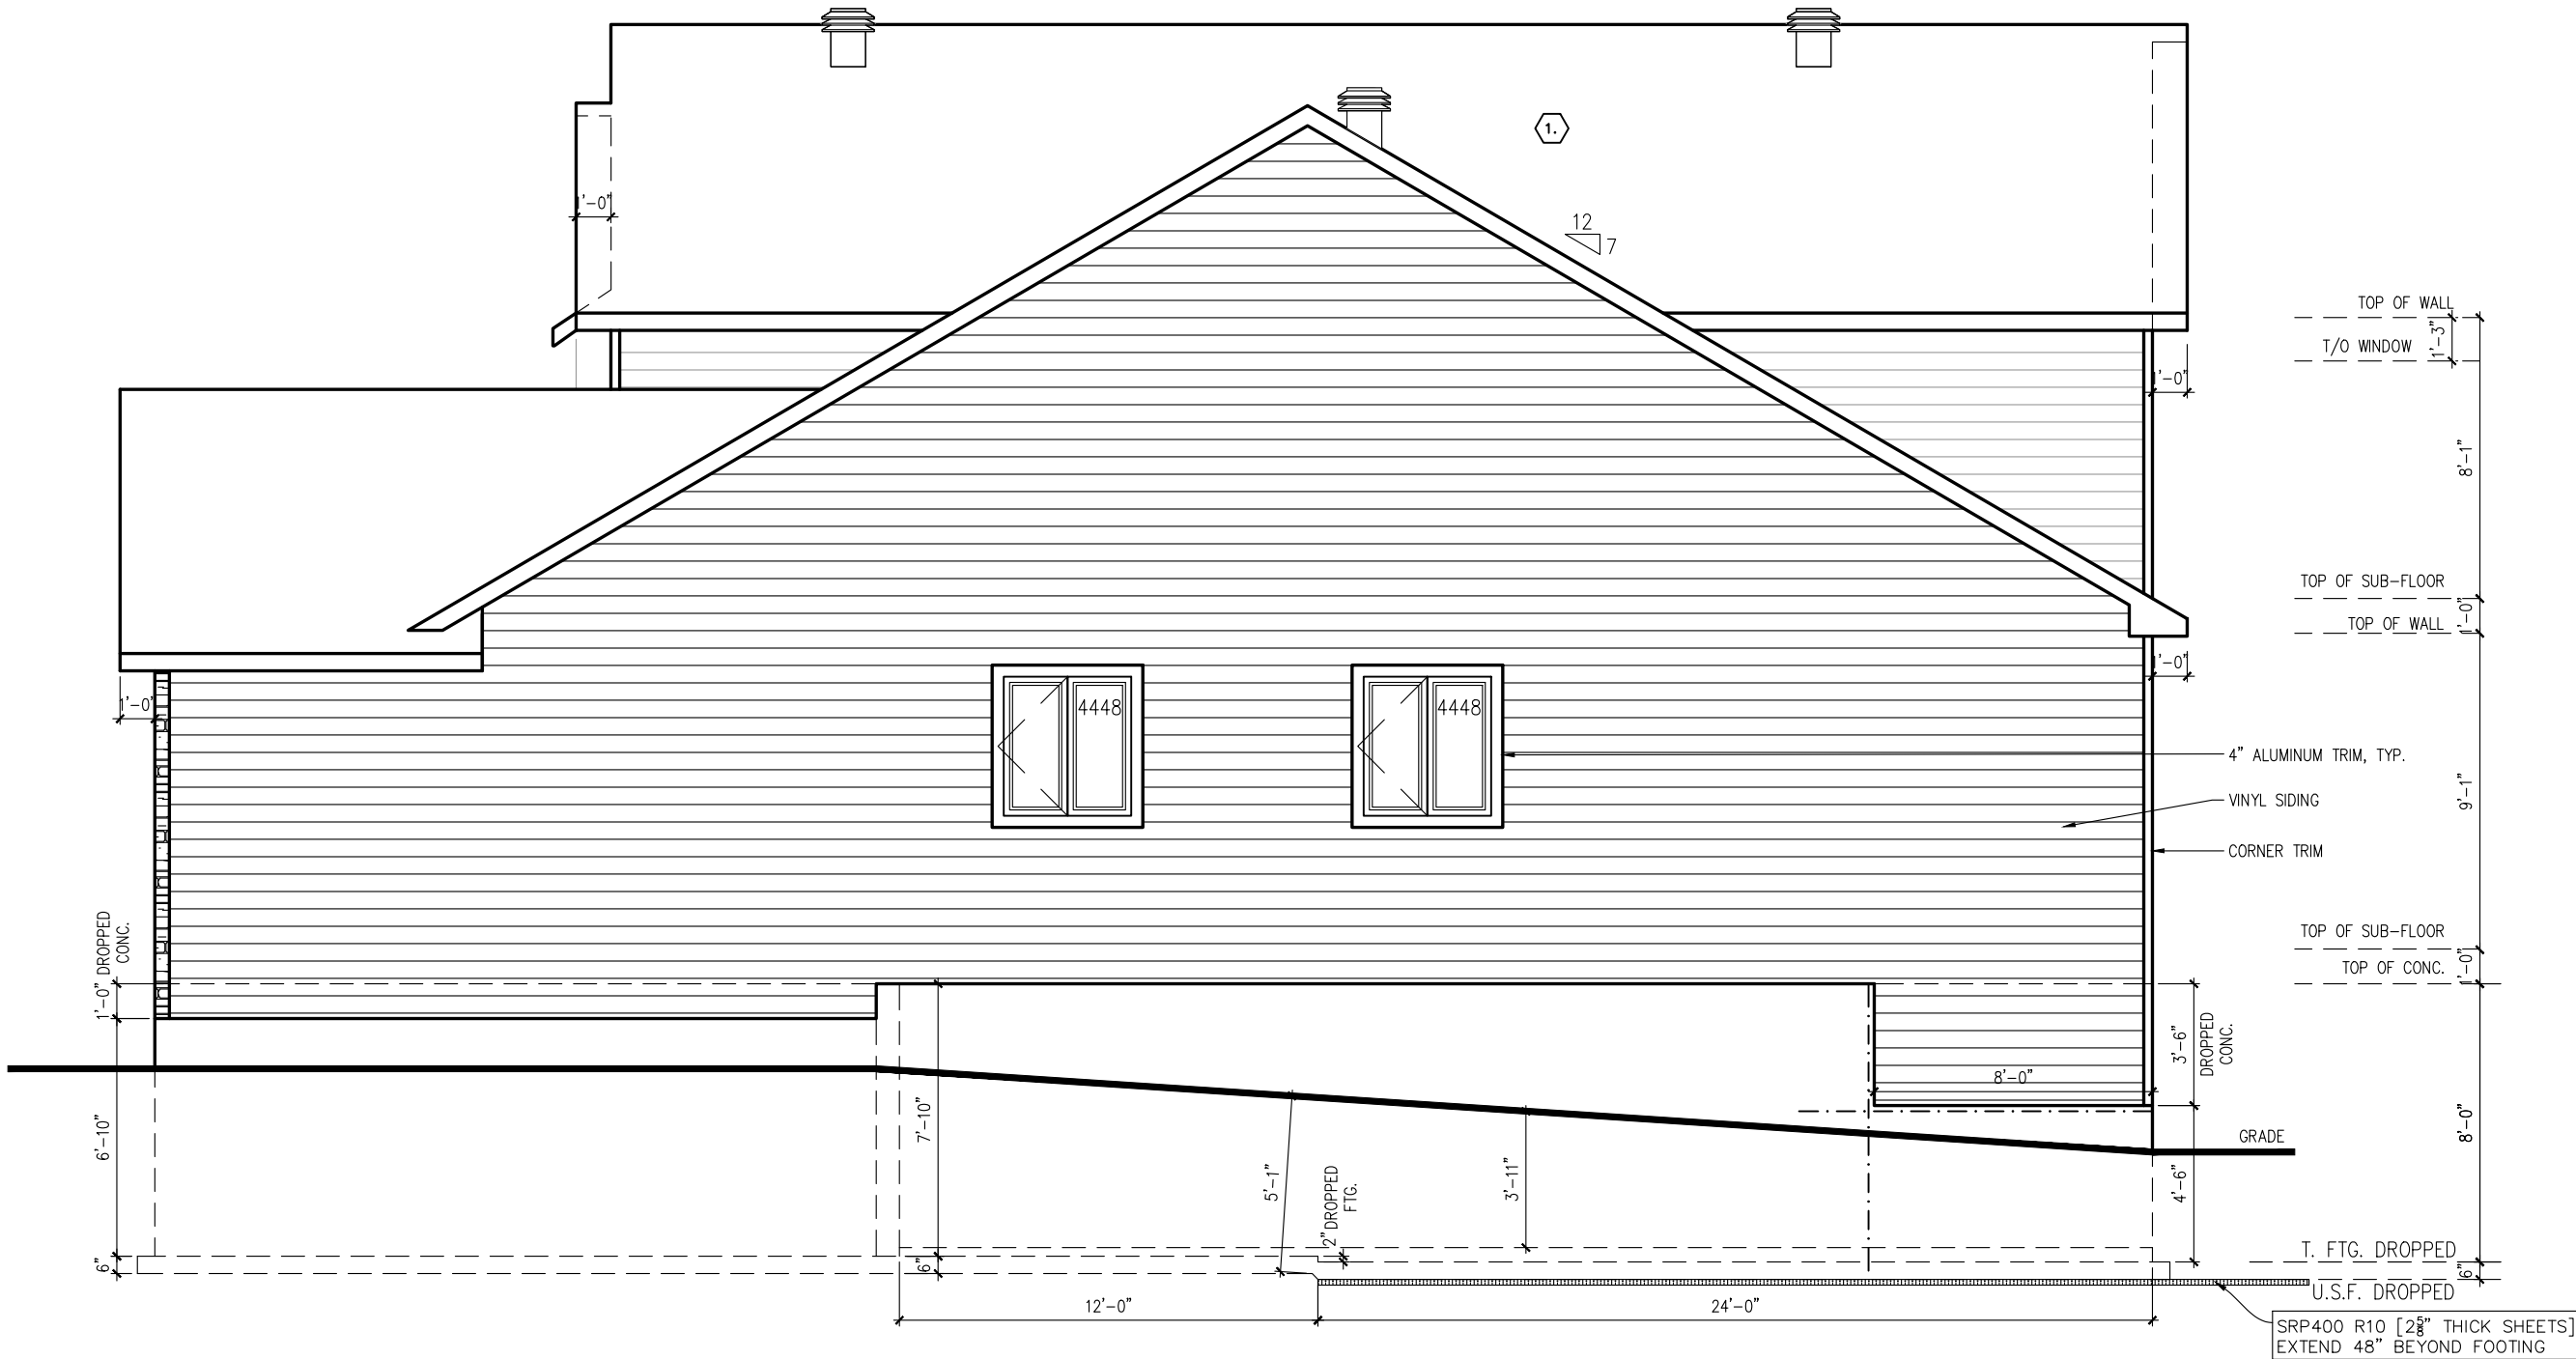

RIGHT SIDE ELEV C



BIRCHWOOD LOFT C -2022

SITE: WHITETAIL RIDGE PHASE 4

LOT NUMBER:  
CIVIC ADDRESS:  
168 FRANK FISHER CRESCENT

118

7	CIVIC ADDRESS CHANGE	08/05/23	CB
6	ISSUED FOR ENGINEERING	02/05/23	CB
5	ISSUED FOR LAYOUTS	18/04/23	CB
4	BEP BLACKLINES	29/03/23	CB
3	PRELIM BLACKLINES	03/03/23	CB
2	FOR REVISED LAYOUTS	13/01/23	SP
No.	Description	dd/mm/yy	By
REVISIONS			

footprint: 50-22-3-0

drawn by: SP

date: JAN 13/16

scale: 3/16"=1'-0"

D.C.L: 202

sheet no:


7C of  
9

# CERTIFIED PERMIT DOCUMENT

A copy of the permit plans & documents shall be kept & maintained on site and made available to an inspector upon request.

2023-07-06

*Full*

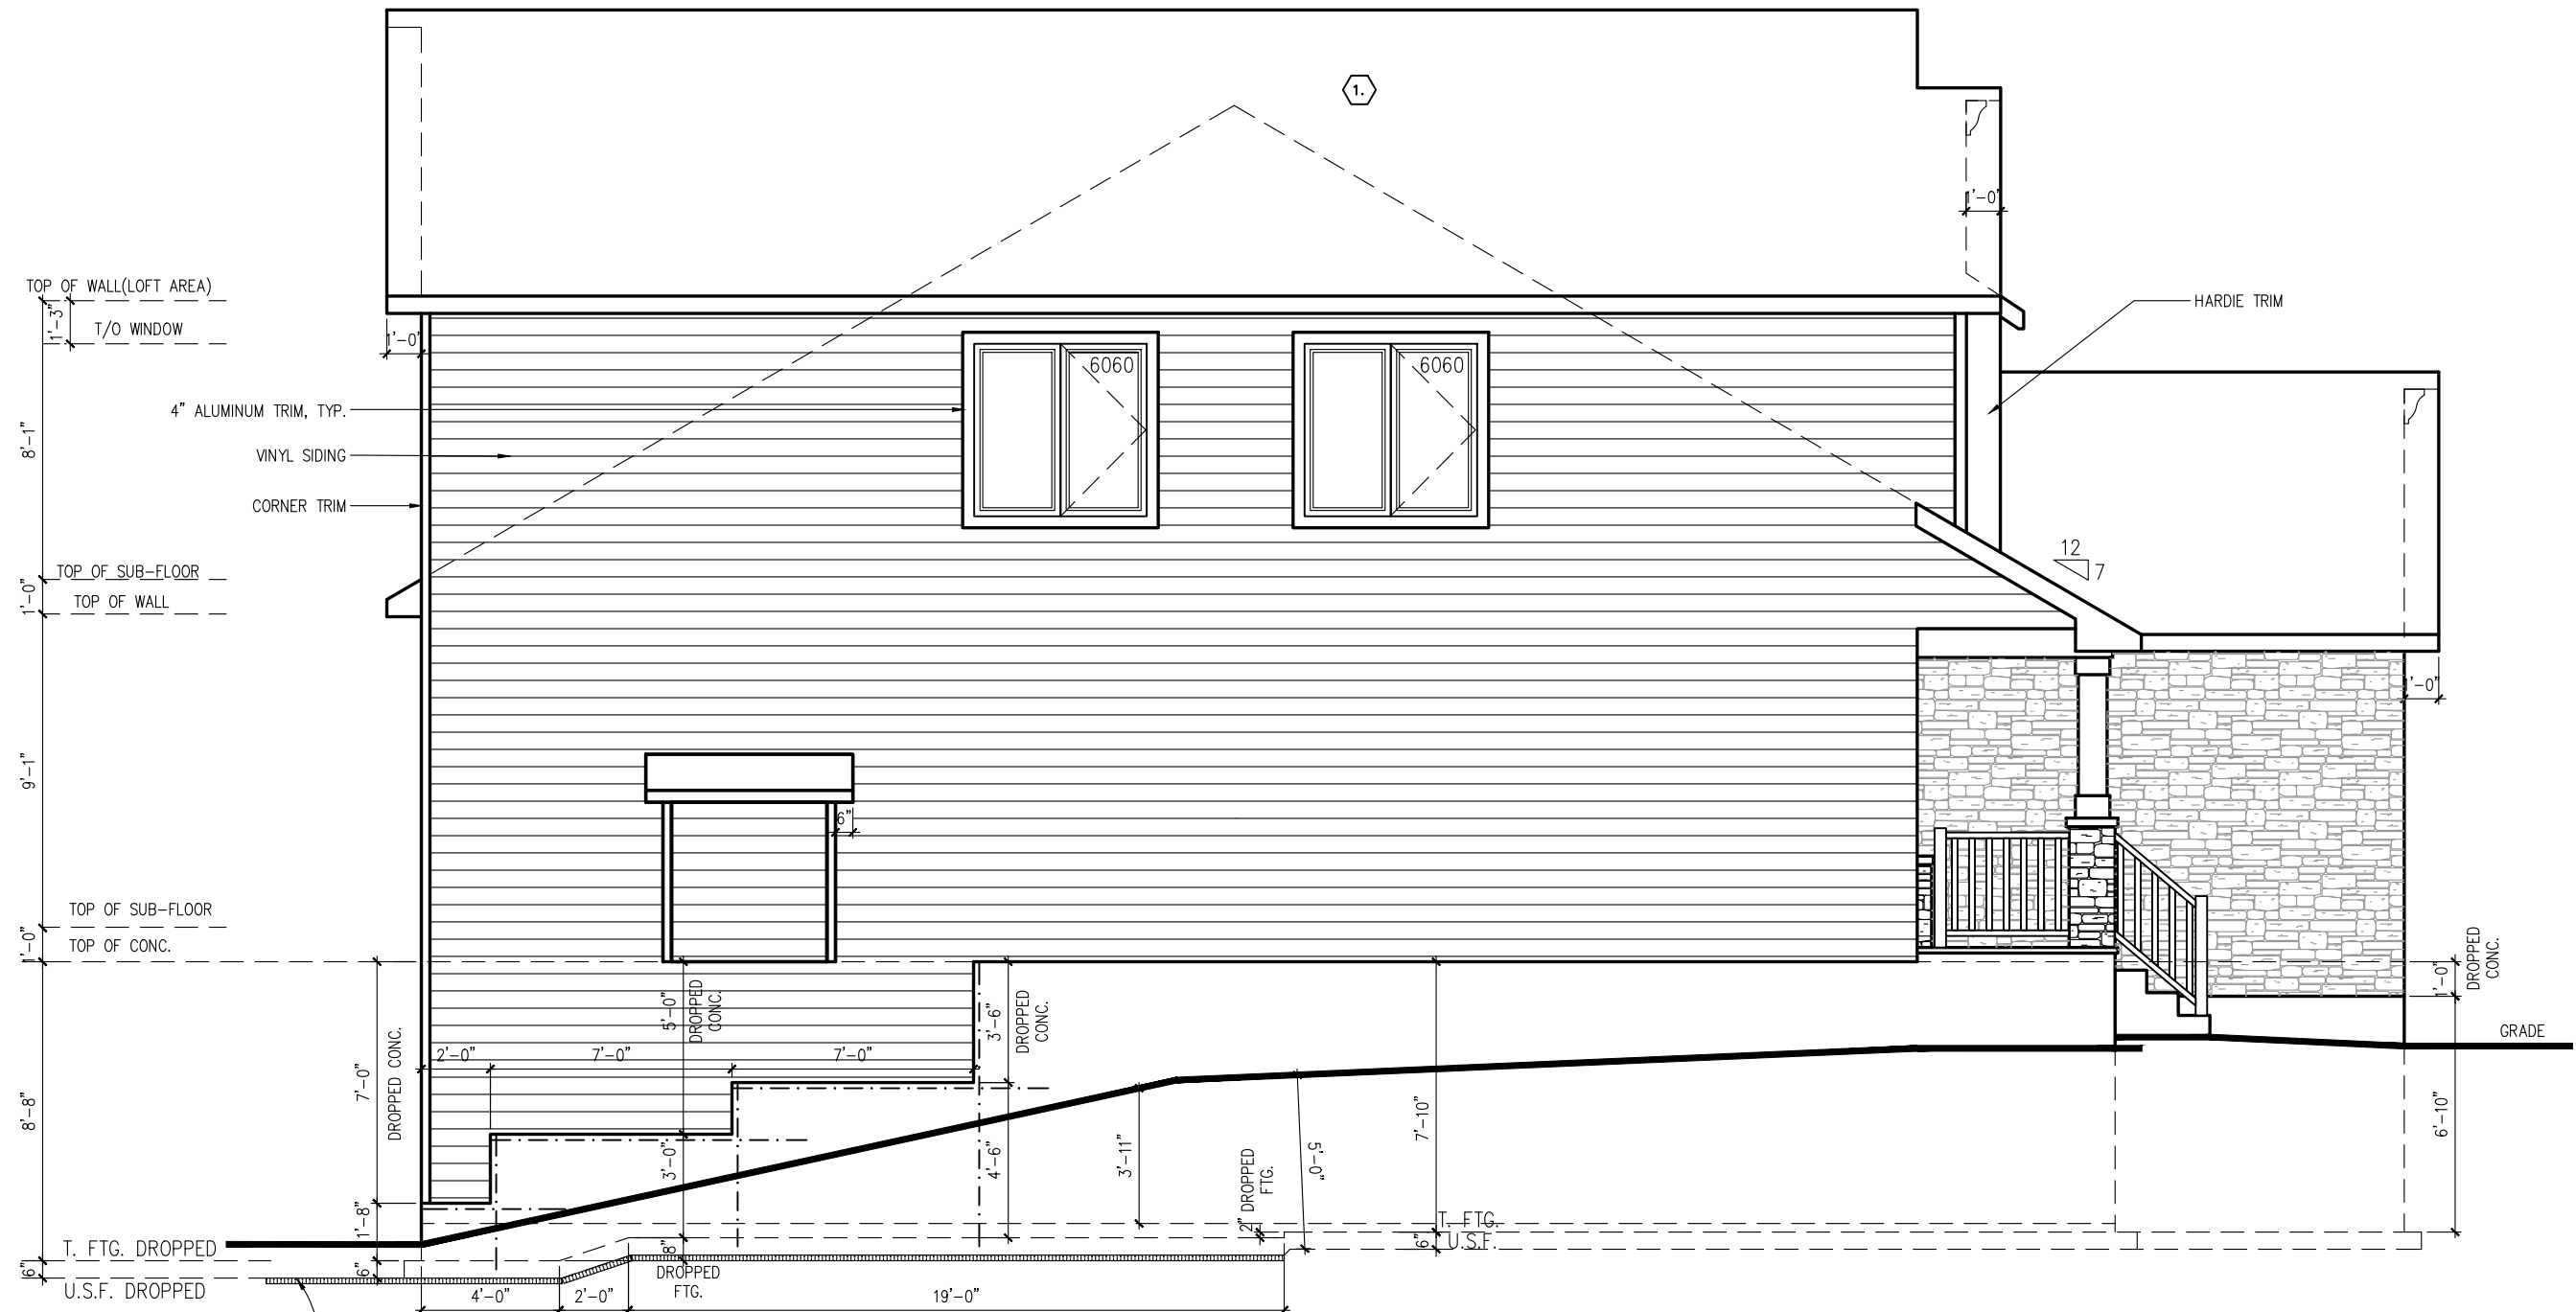

LEFT SIDE ELEV C



**BIRCHWOOD LOFT C -2022**

SITE: WHITETAIL RIDGE PHASE 4

LOT NUMBER: **118**

CIVIC ADDRESS: 168 FRANK FISHER CRESCENT

7	CIVIC ADDRESS CHANGE	08/05/23	CB
6	ISSUED FOR ENGINEERING	02/05/23	CB
5	ISSUED FOR LAYOUTS	18/04/23	CB
4	BEP BLACKLINES	29/03/23	CB
3	PRELIM BLACKLINES	03/03/23	CB
2	FOR REVISED LAYOUTS	13/01/23	SP
No.	Description	dd/mm/yy	By
REVISIONS			

footprint: 50-22-3-0

drawn by: SP

date: JAN 13/16

scale: 3/16"=1'-0"

D.C.L: 202

sheet no: **6C of 9**



CERTIFIED PERMIT DOCUMENT

A copy of the permit plans & documents shall be kept & maintained on site and made available to an inspector upon request.

2023-07-06

full



REAR ELEVATION C



BIRCHWOOD LOFT C -2022

SITE: WHITETAIL RIDGE PHASE 4

LOT NUMBER: 118

CIVIC ADDRESS: 168 FRANK FISHER CRESCENT

7	CIVIC ADDRESS CHANGE	08/05/23	CB
6	ISSUED FOR ENGINEERING	02/05/23	CB
5	ISSUED FOR LAYOUTS	18/04/23	CB
4	BEP BLACKLINES	29/03/23	CB
3	PRELIM BLACKLINES	03/03/23	CB
2	FOR REVISED LAYOUTS	13/01/23	SP
No.	Description	dd/mm/yy	By
REVISIONS			

footprint: 50-22-3-0

drawn by: SP

date: JAN 13/16

scale: 3/16"=1'-0"


D.C.L: 202

sheet no: 8 of 9


CERTIFIED PERMIT DOCUMENT

A copy of the permit plans & documents shall be kept & maintained on site and made available to an inspector upon request.

2023-07-06

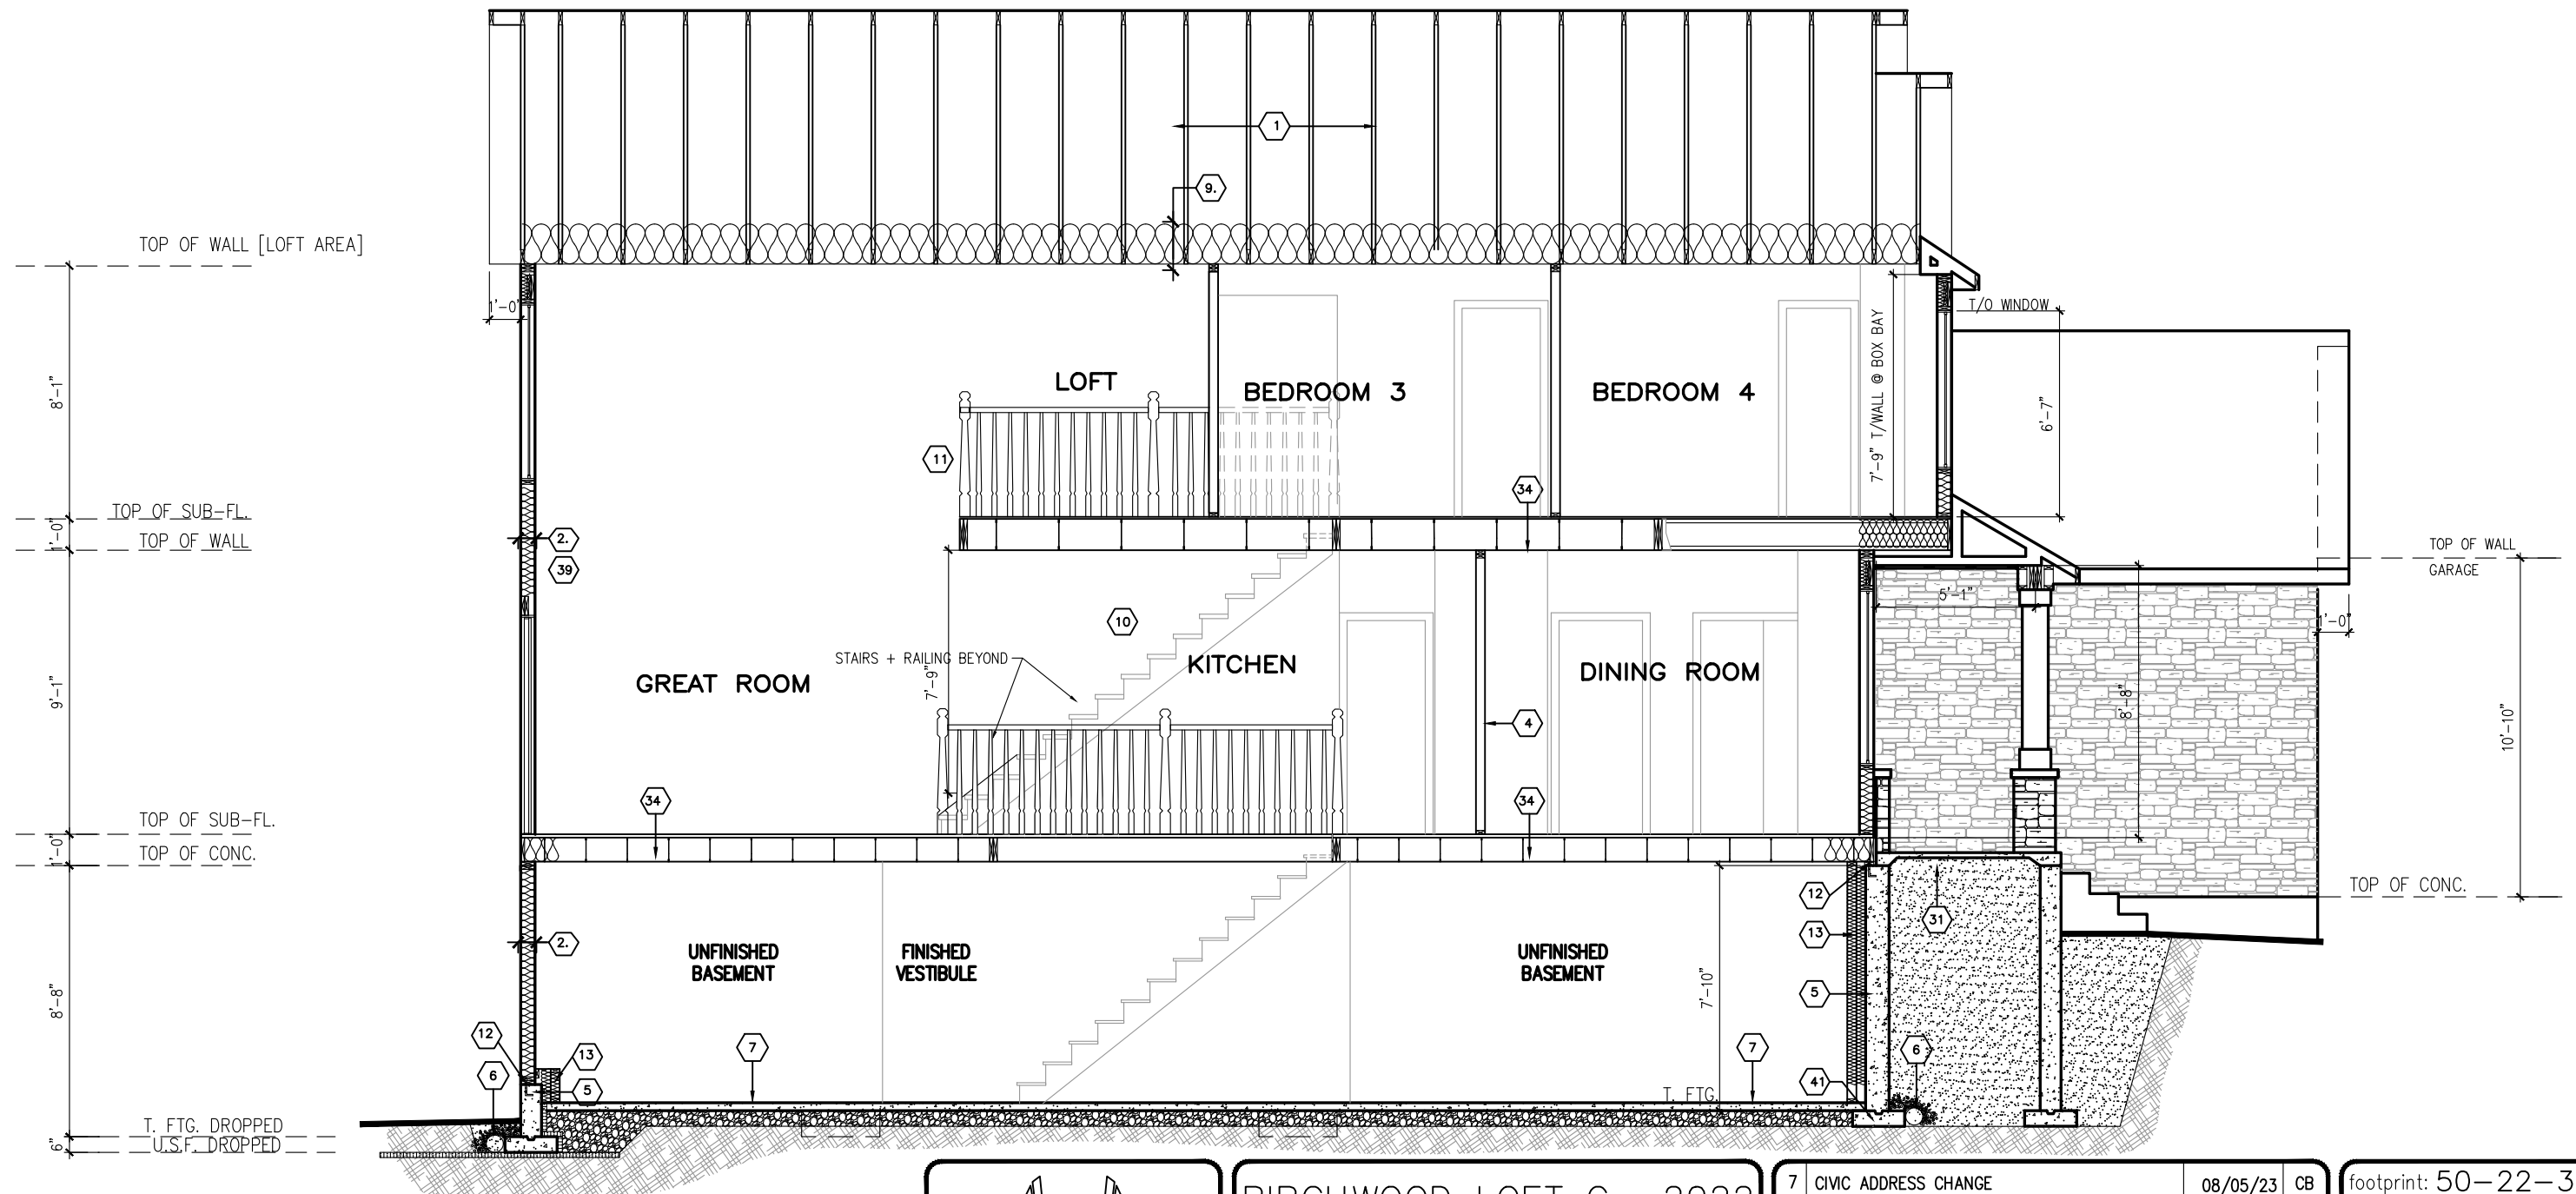

SECTION ELEVATION C



PHOENIX HOMES

BIRCHWOOD LOFT C -2022

SITE: WHITETAIL RIDGE PHASE 4

LOT NUMBER:


118

CIVIC ADDRESS:  
168 FRANK FISHER CRESCENT

7	CIVIC ADDRESS CHANGE	08/05/23	CB
6	ISSUED FOR ENGINEERING	02/05/23	CB
5	ISSUED FOR LAYOUTS	18/04/23	CB
4	BEP BLACKLINES	29/03/23	CB
3	PRELIM BLACKLINES	03/03/23	CB
2	FOR REVISED LAYOUTS	13/01/23	SP
No.	Description	dd/mm/yy	By
REVISIONS			

footprint: 50-22-3-C	
drawn by:	SP
date:	JAN 13/16
scale:	3/16"=1'-0"
D.C.L: 202	9C of 9
sheet no:	



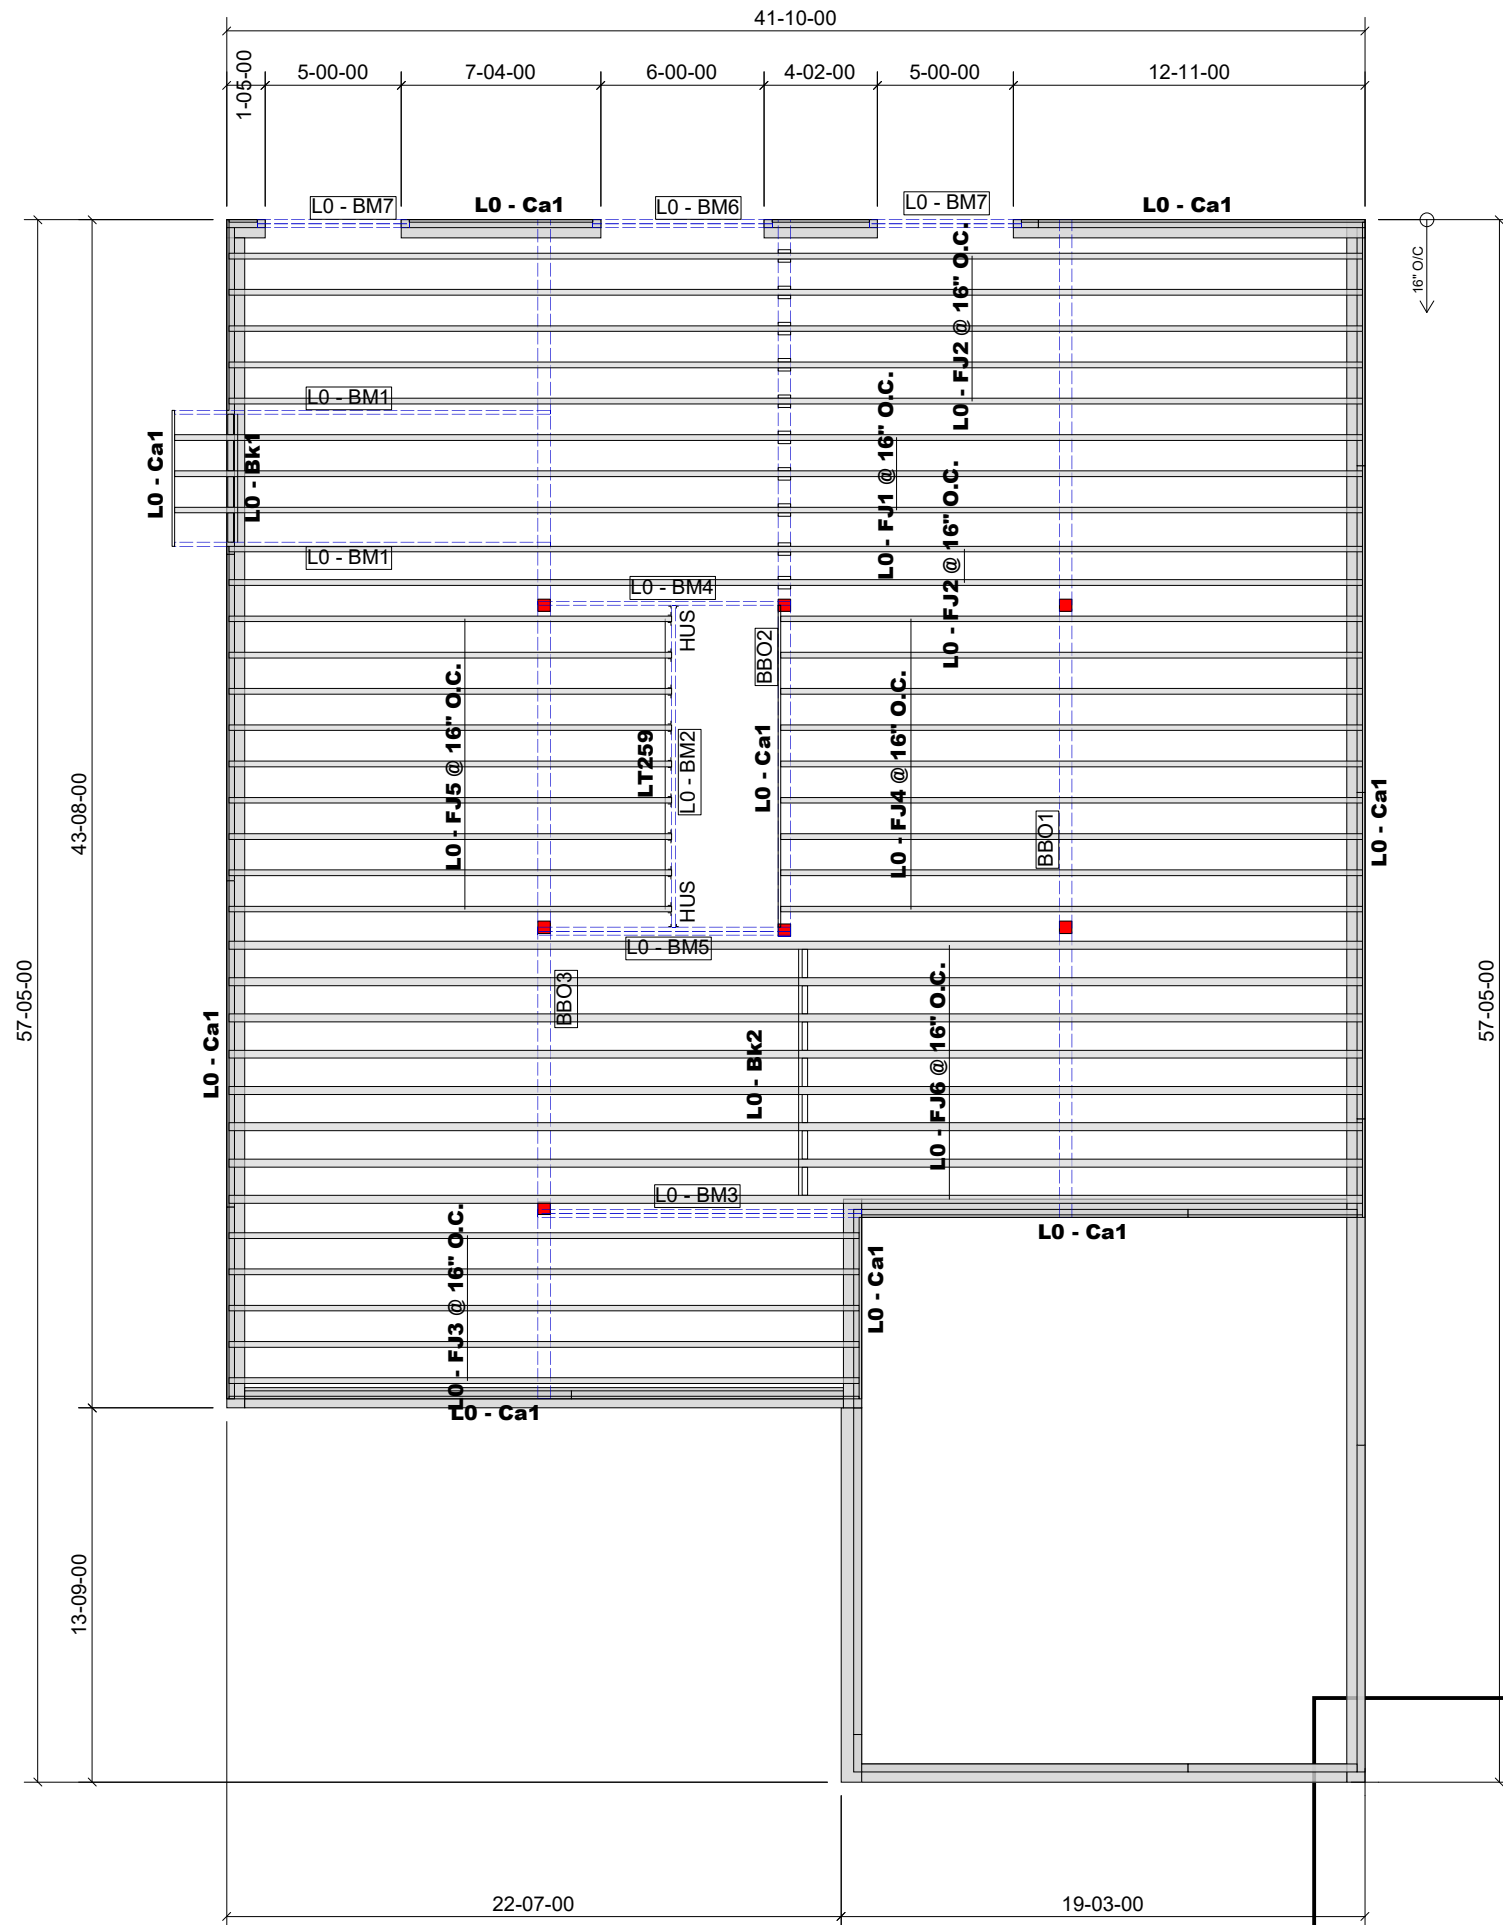

PROVIDE P.ENG APPROVED FLOOR  
DRAWINGS AND SPECIFICATIONS  
TO BUILDING INSPECTOR AT  
FRAMING INSPECTION

LEVEL AND FLOOR CONTAINER NOTES	
Current Date:	4/19/2023
File Name:	WTR4-118 Birchwood C Loft.mmdl
Level Name:	1st Floor
Building Code - Design Methodology:	NBCC 2015
Floor Container:	FC1
Floor Area Loading is:	40 Live Load & 15 Dead Load
Maximum Allowed Deflection	L/480 Live Load & L/240 Total Load

Products					
PlotID	Length	Product	Plies	Net Qty	Fab Type
L0 - FJ1 @ 16" O.C.	44-00-00	9 1/2" NI-20	1	3	MFD
L0 - FJ2 @ 16" O.C.	42-00-00	9 1/2" NI-20	1	7	MFD
L0 - FJ3 @ 16" O.C.	24-00-00	9 1/2" NI-20	1	5	MFD
L0 - FJ4 @ 16" O.C.	22-00-00	9 1/2" NI-20	1	9	MFD
L0 - FJ5 @ 16" O.C.	17-00-00	9 1/2" NI-20	1	9	MFD
L0 - FJ6 @ 16" O.C.	42-00-00	9 1/2" NI-80	1	8	MFD
L0 - BM1	14-00-00	1 3/4" x 9 1/2" (2.0E 3100) WestFraser LVL	1	2	MFD
L0 - BM2	12-00-00	1 3/4" x 9 1/2" (2.0E 3100) WestFraser LVL	1	1	MFD
L0 - BM3	12-00-00	1 3/4" x 9 1/2" (2.0E 3100) WestFraser LVL	2	2	MFD
L0 - BM4	10-00-00	1 3/4" x 9 1/2" (2.0E 3100) WestFraser LVL	1	1	MFD
L0 - BM5	10-00-00	1 3/4" x 9 1/2" (2.0E 3100) WestFraser LVL	2	2	MFD
L0 - BM6	7-00-00	1 3/4" x 9 1/2" (2.0E 3100) WestFraser LVL	2	2	MFD
L0 - BM7	6-00-00	1 3/4" x 9 1/2" (2.0E 3100) WestFraser LVL	2	4	MFD
L0 - Ca1	12-00-00	1 1/8" x 9 1/2" APA Rim Board	1	14	FF
L0 - Bk1	5-00-00	9 1/2" NI-20	1	1	FF
L0 - Bk2	8-00-00	9 1/2" NI-20	1	1	MFD

Accessories					
PlotID	Length	Product	Plies	Net Qty	Fab Type
3/4" Plywood or OSB (23/32" APA Rated Sheathing 48/24 Exposure 1)			1	54	MFD

Connector Summary				
Qty	Manuf	Product	Skew	Supported Mtl
9	SIM	LT259	-	9 1/2" NI-20
2	SIM	HUS18110	-	9 1/2" WF LVL

### CERTIFIED PERMIT DOCUMENT

A copy of the permit plans & documents  
shall be kept & maintained on site and made  
available to an inspector upon request.

2023-07-06

#### THIS DESIGN COMPLIES WITH:

- PART 4 OR 9 OF OBC 2012 Reg. 332/12 (Jan 2020 Amendment)
- NORDIC LAM CCMC: 13216-R
- NORDIC JOISTS CCMC: 13032-R
- WEST FRASER CCMC: 12904

(REFER TO INDIVIDUAL FLOOR DRAWINGS  
FOR SPECIFIC LOADS & SPACING)

#### FLOOR NOTES:

- FLOOR JOIST SYSTEMS ABOVE THE GARAGE HAS BEEN DESIGNED WITHOUT A DIRECTLY APPLIED CEILING. USE APPLICABLE BLOCKING OR STRAPPING WHERE REQUIRED AS INDICATED ON THE FRAMING PLAN.
- BLOCKING MATERIAL WILL BE SUPPLIED AND INDICATED AS "BLOCKING". NO LONGER ONLY 12' LENGTHS.




GRANDOR LUMBER INC.  
ALPHA LUMBER GROUP

JOB:

PHOENIX HOMES  
WHITE TAIL RIDGE  
WTR3-118  
BIRCHWOOD 2022 C  
W/ LOFT

1ST FLOOR 1 OF 2

DATE: 5/2/2023

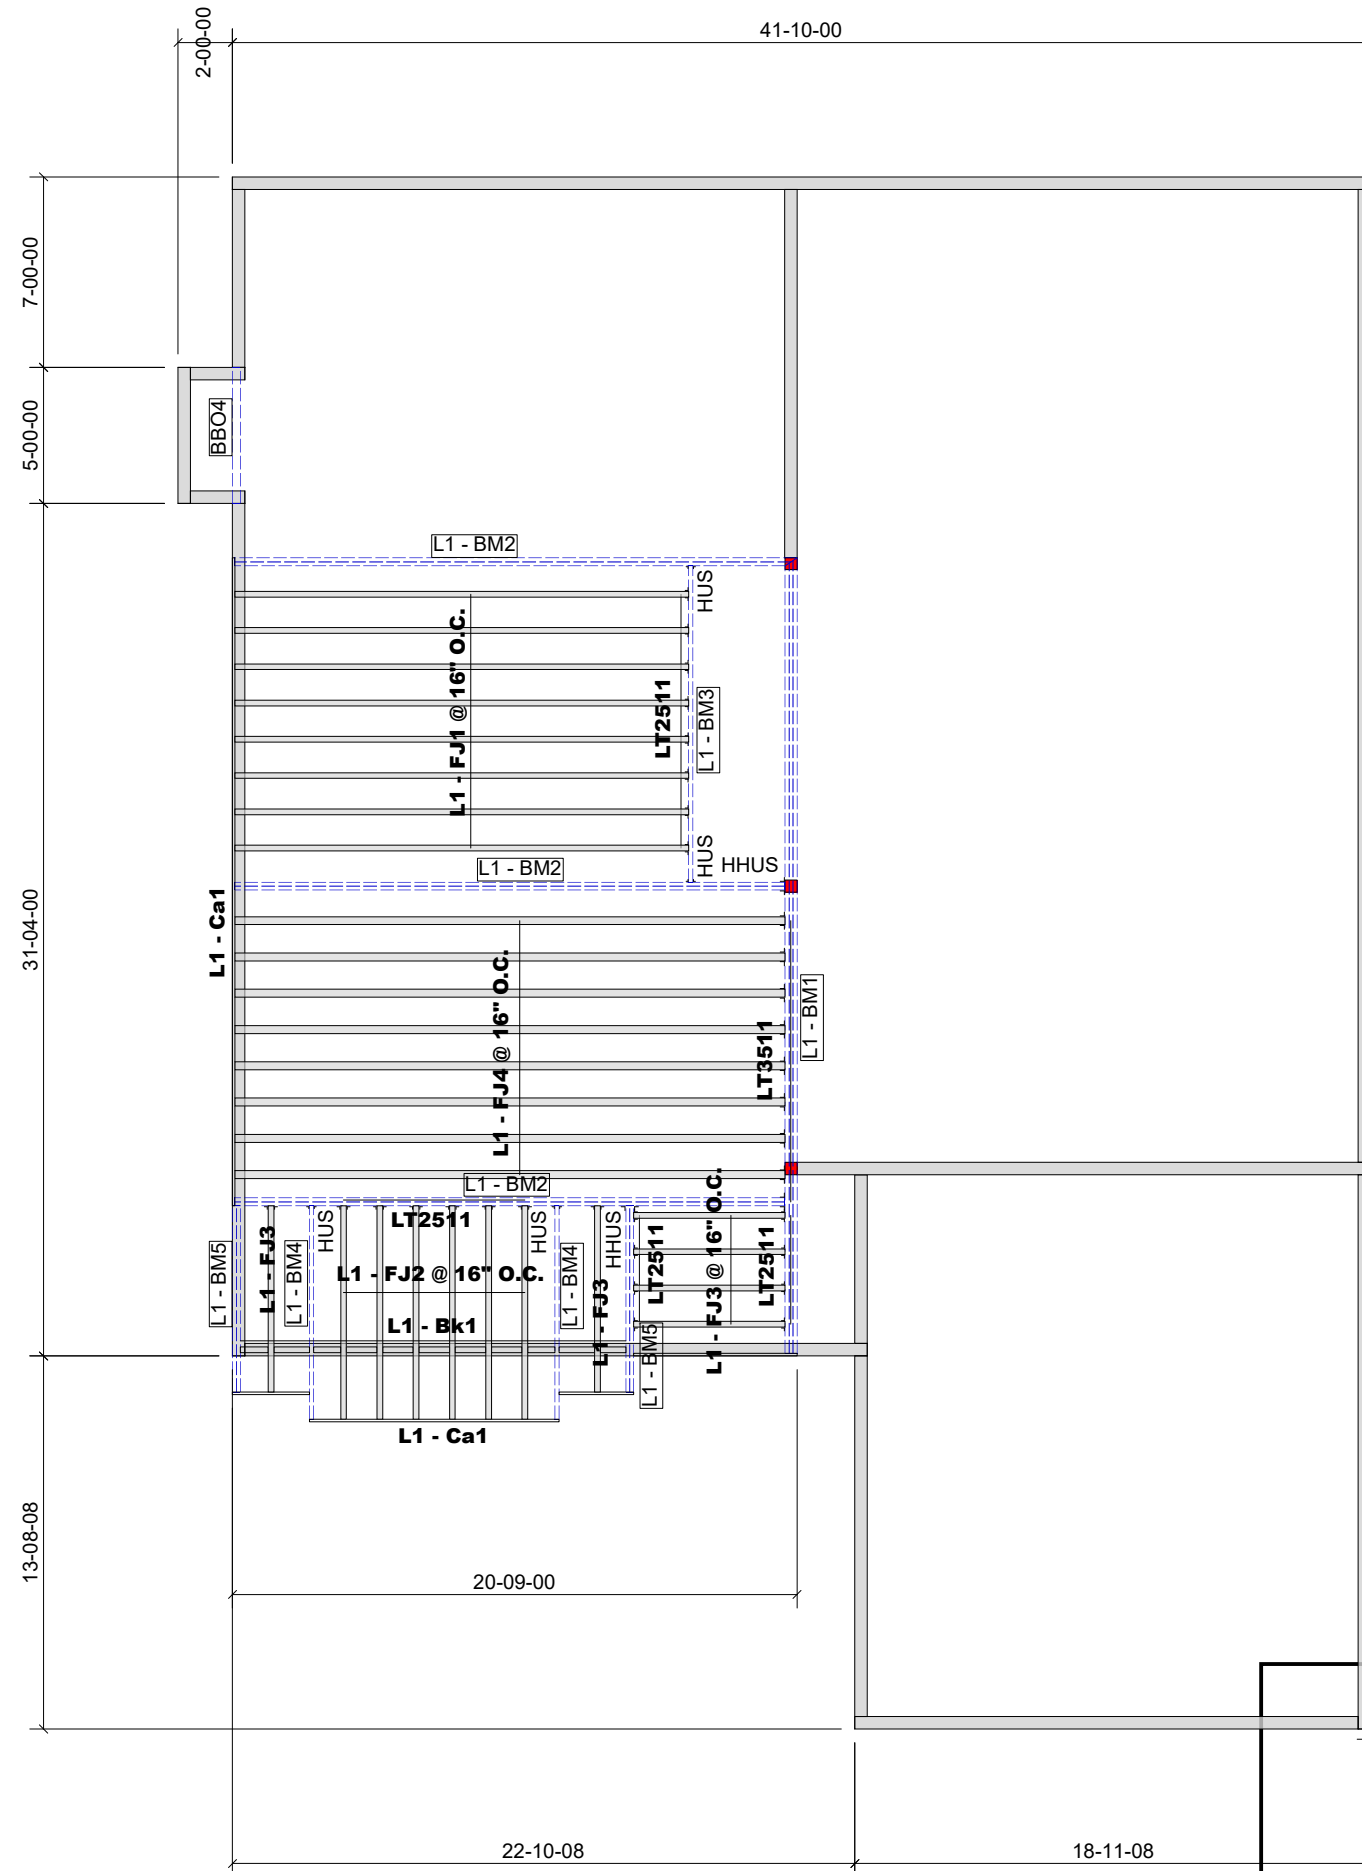

LEVEL AND FLOOR CONTAINER NOTES	
Current Date:	4/19/2023
File Name:	WTR4-118 Birchwood C Loft.mmdl
Level Name:	2nd Floor
Building Code - Design Methodology:	NBCC 2015
Floor Container:	FC2
Floor Area Loading is:	40 Live Load & 15 Dead Load
Maximum Allowed Deflection	L/480 Live Load & L/240 Total Load

Products					
PlotID	Length	Product	Plies	Net Qty	Fab Type
L1 - FJ1 @ 16" O.C.	17-00-00	11 7/8" NI-20	1	8	MFD
L1 - FJ2 @ 16" O.C.	8-00-00	11 7/8" NI-20	1	6	MFD
L1 - FJ3	7-00-00	11 7/8" NI-20	1	2	MFD
L1 - FJ3 @ 16" O.C.	6-00-00	11 7/8" NI-20	1	4	MFD
L1 - FJ4 @ 16" O.C.	22-00-00	11 7/8" NI-80	1	8	MFD
L1 - BM1	30-00-00	1 3/4" x 11 7/8" (2.0E 3100) WestFraser LVL	3	3	MFD
L1 - BM2	21-00-00	1 3/4" x 11 7/8" (2.0E 3100) WestFraser LVL	2	6	MFD
L1 - BM3	12-00-00	1 3/4" x 11 7/8" (2.0E 3100) WestFraser LVL	1	1	MFD
L1 - BM4	8-00-00	1 3/4" x 11 7/8" (2.0E 3100) WestFraser LVL	1	2	MFD
L1 - BM5	7-00-00	1 3/4" x 11 7/8" (2.0E 3100) WestFraser LVL	2	4	MFD
L1 - Ca1	12-00-00	1 1/8" x 11 7/8" APA Rim Board	1	4	FF
L1 - Bk1	13-00-00	11 7/8" NI-20	1	1	MFD

Accessories						
PlotID	Length	Product		Plies	Net Qty	Fab Type
		3/4" Plywood or OSB (23/32" APA Rated Sheathing 48/24 Exposure 1)		1	19	MFD

Connector Summary				
Qty	Manuf	Product	Skew	Supported Mtl
4	SIM	HUS18110	-	1 3/4" x 11 7/8" (2.0E 3100) WestFraser LVL
3	SIM	HHUS410	-	2- 1 3/4" x 11 7/8" (2.0E 3100) WestFraser LVL
8	SIM	LT3511	-	11 7/8" NI-80
24	SIM	LT2511	-	11 7/8" NI-20

CERTIFIED PERMIT DOCUMENT

A copy of the permit plans & documents shall be kept & maintained on site and made available to an inspector upon request.

2023-07-06

THIS DESIGN COMPLIES WITH:

- PART 4 OR 9 OF OBC 2012 Reg. 332/12 (Jan 2020 Amendment)
- NORDIC LAM CCMC: 13216-R
- NORDIC JOISTS CCMC: 13032-R
- WEST FRASER CCMC: 12904

(REFER TO INDIVIDUAL FLOOR DRAWINGS FOR SPECIFIC LOADS & SPACING)

FLOOR NOTES:

- FLOOR JOIST SYSTEMS ABOVE THE GARAGE HAS BEEN DESIGNED WITHOUT A DIRECTLY APPLIED CEILING. USE APPLICABLE BLOCKING OR STRAPPING WHERE REQUIRED AS INDICATED ON THE FRAMING PLAN.
- BLOCKING MATERIAL WILL BE SUPPLIED AND INDICATED AS "BLOCKING". NO LONGER ONLY 12' LENGTHS.




GRANDOR LUMBER INC.  
ALPHA LUMBER GROUP

JOB:  
PHOENIX HOMES  
WHITE TAIL RIDGE  
WTR3-118  
BIRCHWOOD 2022 C  
W/ LOFT  
2ND FLOOR 2 OF 2  
DATE: 5/2/2023



PROVIDE A COMPLETE PACKAGE OF SEALED TRUSSES AT TIME OF FRAMING INSPECTION.

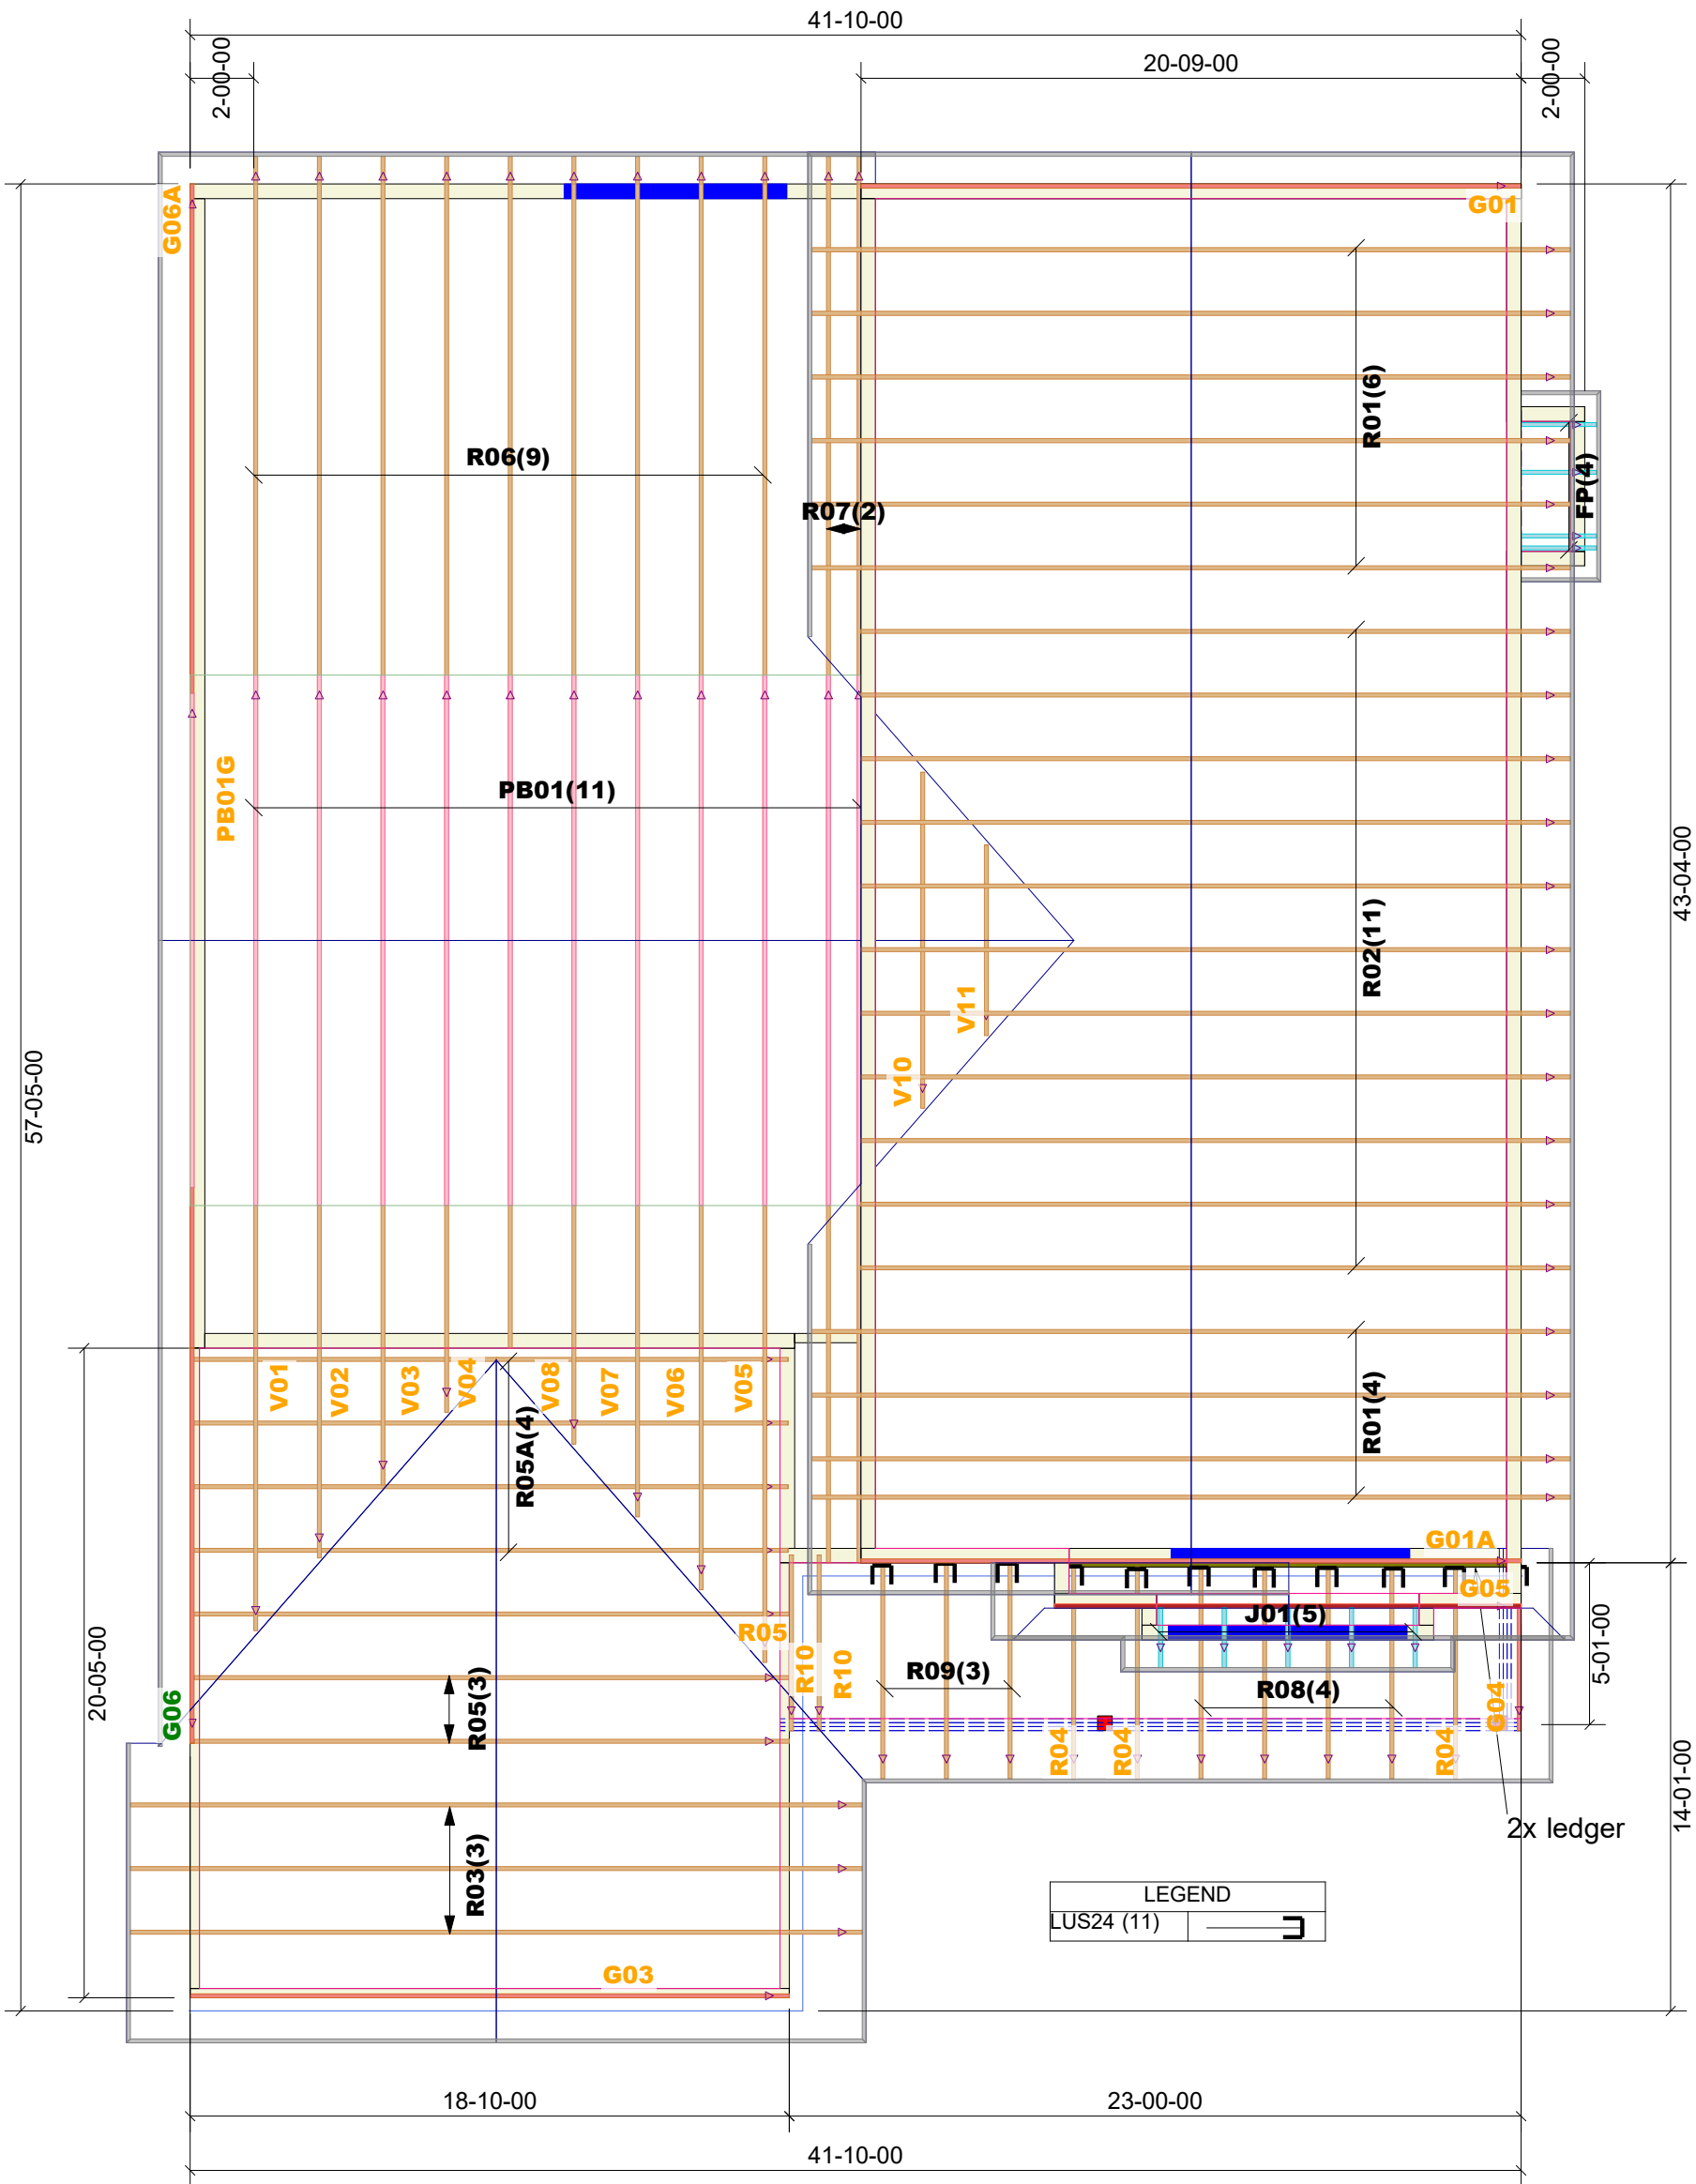

CERTIFIED PERMIT DOCUMENT

A copy of the permit plans & documents shall be kept & maintained on site and made available to an inspector upon request.

2023-07-06

TYPICAL OTTAWA DESIGN LOADS

Member	Load Type	PT 9	PT 4
Top Chord	Snow	37.1	50
	Dead	3	5-10
Bot Chord	Live	0	10
	Dead	7	7

TYPICAL SPACING = 24.0 IN C/C

THIS DESIGN COMPLIES WITH:

- PART 4 OR 9 OF OBC 2012 Reg. 332/12
- CSA 086-09
- CCMC ACCEPTANCE 11996-L, 0319-L, 13270-L
- TPIC 2011

(REFER TO INDIVIDUAL TRUSS DRAWINGS FOR SPECIFIC LOADS & SPACING)

HURRICANE AND SEISMIC TIES:

- ANY TIES SPECIFIED ON THIS LAYOUT FOR UPLIFT OR SEISMIC CONNECTIONS MUST BE REVIEWED AND APPROVED BY THE BUILDING DESIGNER/ENGINEER, AS STATED IN THE TPIC 2011. THE TRANSFER OF THESE LOADS TO THE ENTIRE STRUCTURE BELOW HAS NOT BEEN ANALYZED.



GRANDCOR  
LUMBER INC.

JOB:  
PHOENIX HOMES  
BIRCHWOOD LOFT - C  
PBIRD4

DATE: 12/16/2021

Fum GMEC960603BNA

Plenum 63" & CAE 10"x23 1/4" X5

Date

Description

191064AR Birchwood B-22 Loft Apt 136 PW

200408.AK Birchwood B-22 Loft Apt 136 PW

CERTIFIED PERMIT DOCUMENT


A copy of the permit plans & documents shall be kept & maintained on site and made available to an inspector upon request.

2023-07-06

full

\*\*FOUNDATION NOTE\*\* INSTALL BSMT WINDOWS FLUSH WITH TOP OF FOUNDATION SEE ELEVATION

Room Name	Heat Loss		
	Htg cfm	Clg cfm	Htg btu
1-BATH	8	8	0
1-BEDROOM 2	61	51	0
1-DININGROOM	75	58	0
1-ENSLUTE	51	46	0
1-FOYER	54	23	0
1-GREATROOM	190	243	0
1-KITCHEN	21	230	0
1-LAUNDRY	33	13	0
1-MASTERBEDROOM	70	88	0
1-STUDY	44	49	0
1-W.I.C.	10	3	361
2-BATH	22	10	0
2-BEDROOM 3	42	31	0
2-BEDROOM 4	82	57	0
2-LOFT	63	34	0
2-STAIRS	31	8	0
2-W.I.C.	17	4	624
BASEMENT	296	44	0
	1170	1000	985

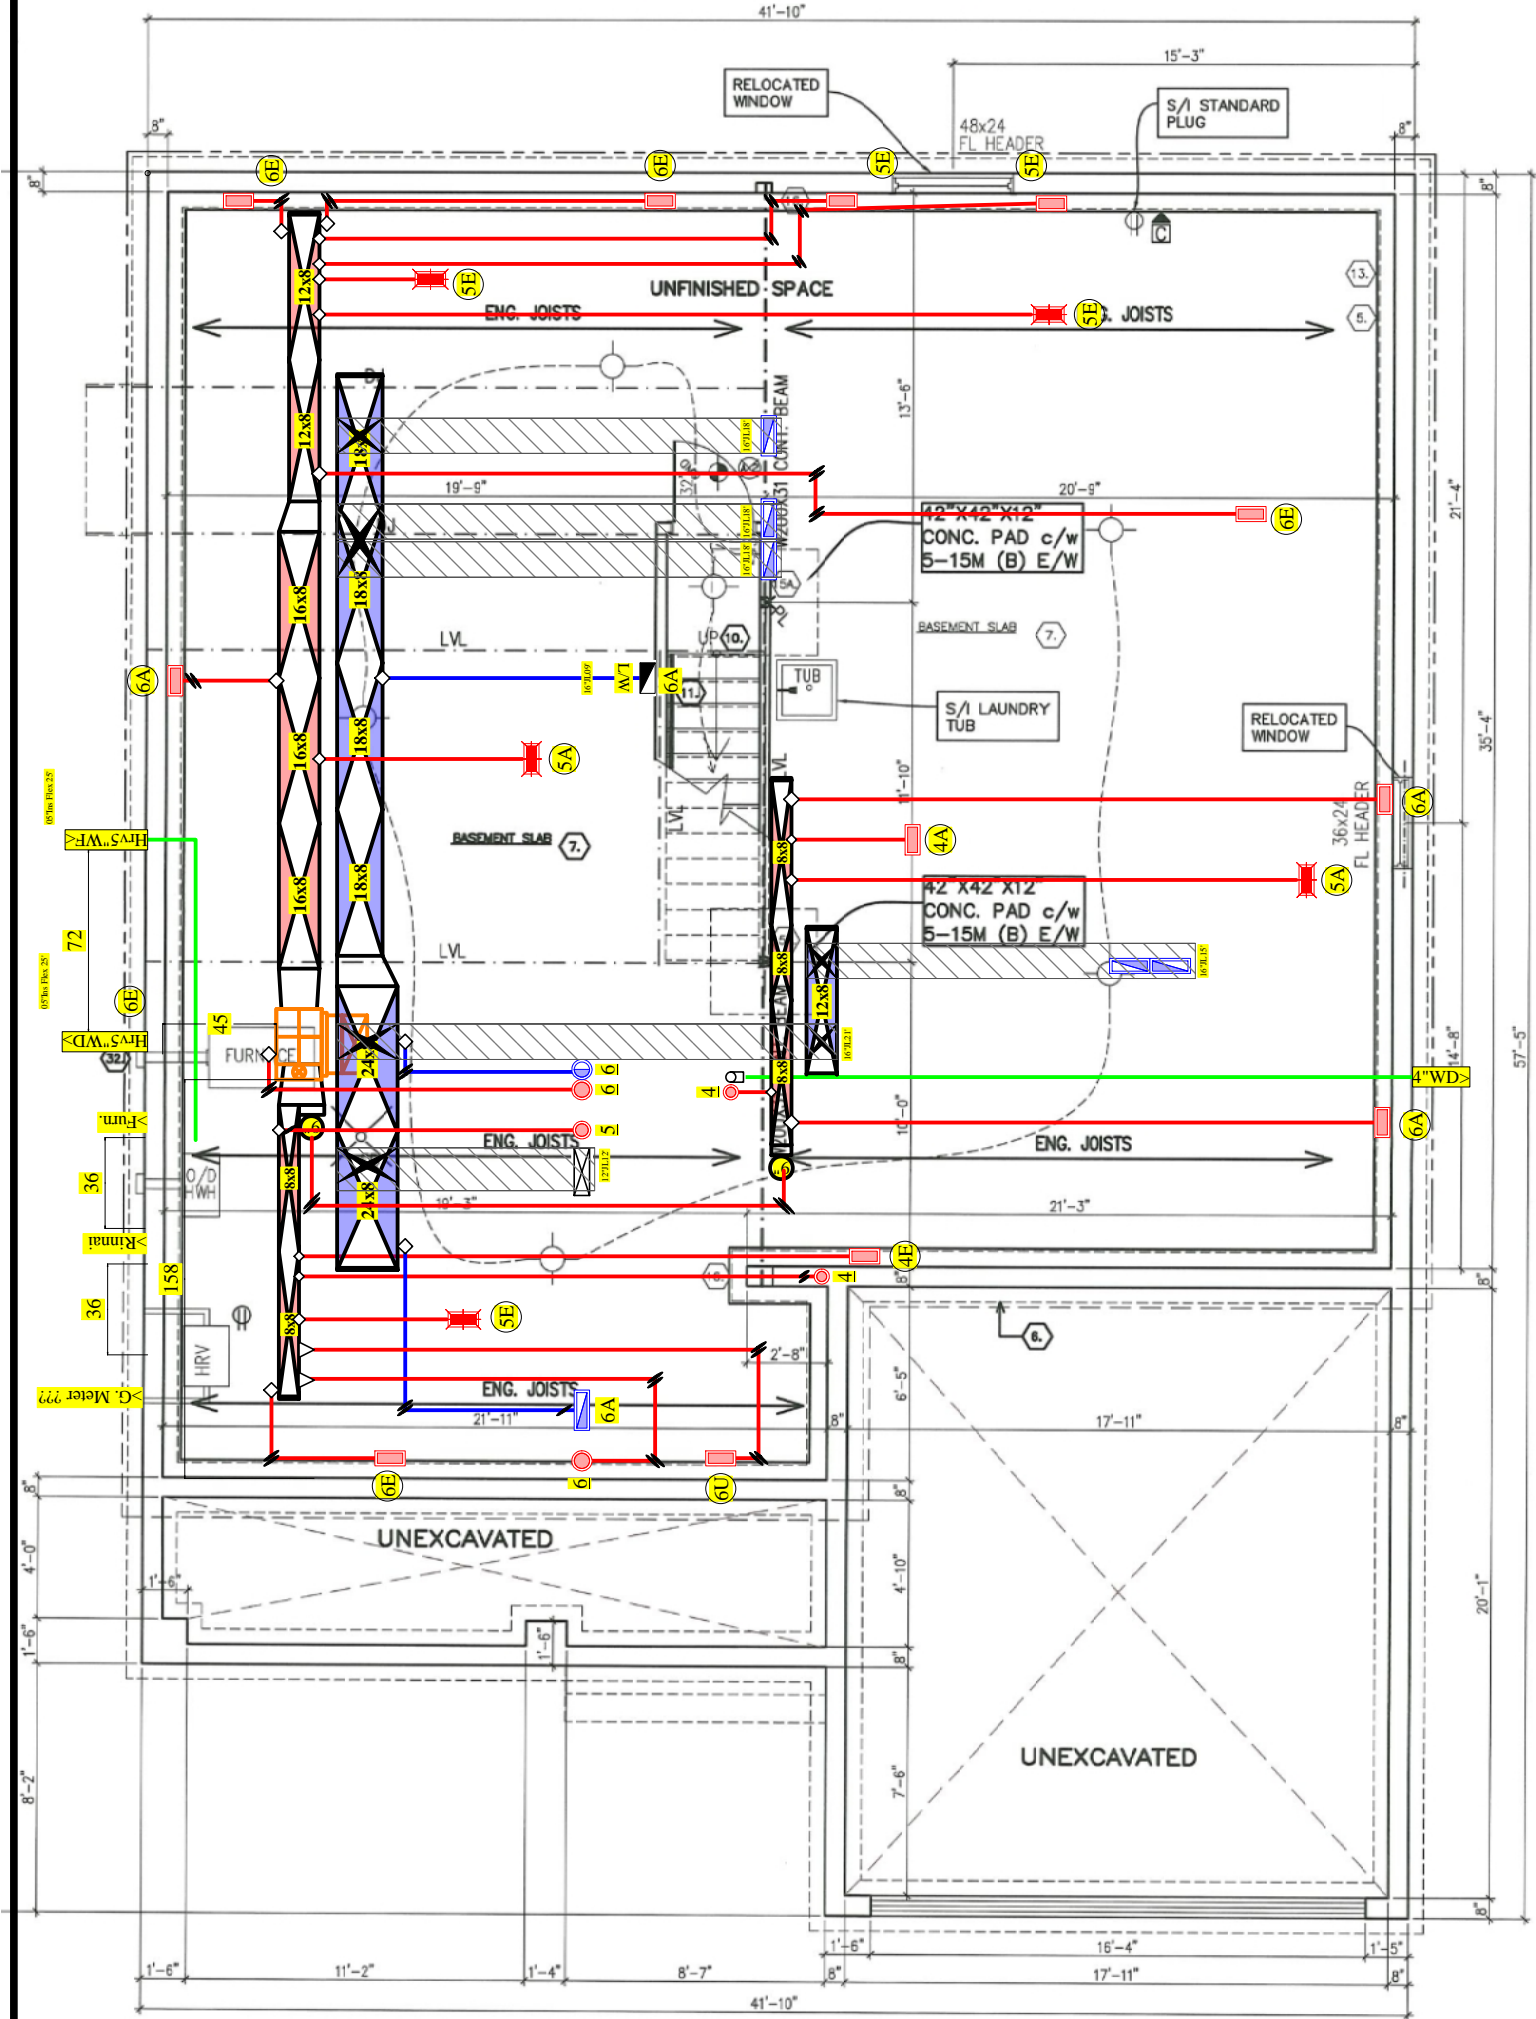




2023-07-06

**\*\*NOTE\*\***  
LINTELS TO BE 2-2X10  
TS ON EACH SIDE U.N.O.

3-WIRE FIXTURES  
WHERE NOTED

Heat Loss				
Room Name	Htg cfm	Clg cfm	Htg btu	
1-BATH	8.	8.	0.	
1-BEDROOM 2	61	51	0.	
1-DININGROOM	75	58	0.	
1-ENSUITE	51	46	0.	
1-FOYER	54	23	0.	
1-GREATROOM	190	243	0.	
1-KITCHEN	21	230	0.	
1-LAUNDRY	33	13	0.	
1-MASTERBEDROOM	70	88	0.	
1-STUDY	44	49	0.	
1-W.I.C.	10	3	361	
2-BATH	22	10	0.	
2-BEDROOM 3	42	31	0.	
2-BEDROOM 4	82	57	0.	
2-LOFT	63	34	0.	
2-STAIRS	31	8	0.	
2-W.I.C.	17	4	624	
BASEMENT	296	44	0.	
	1170	1006	985	

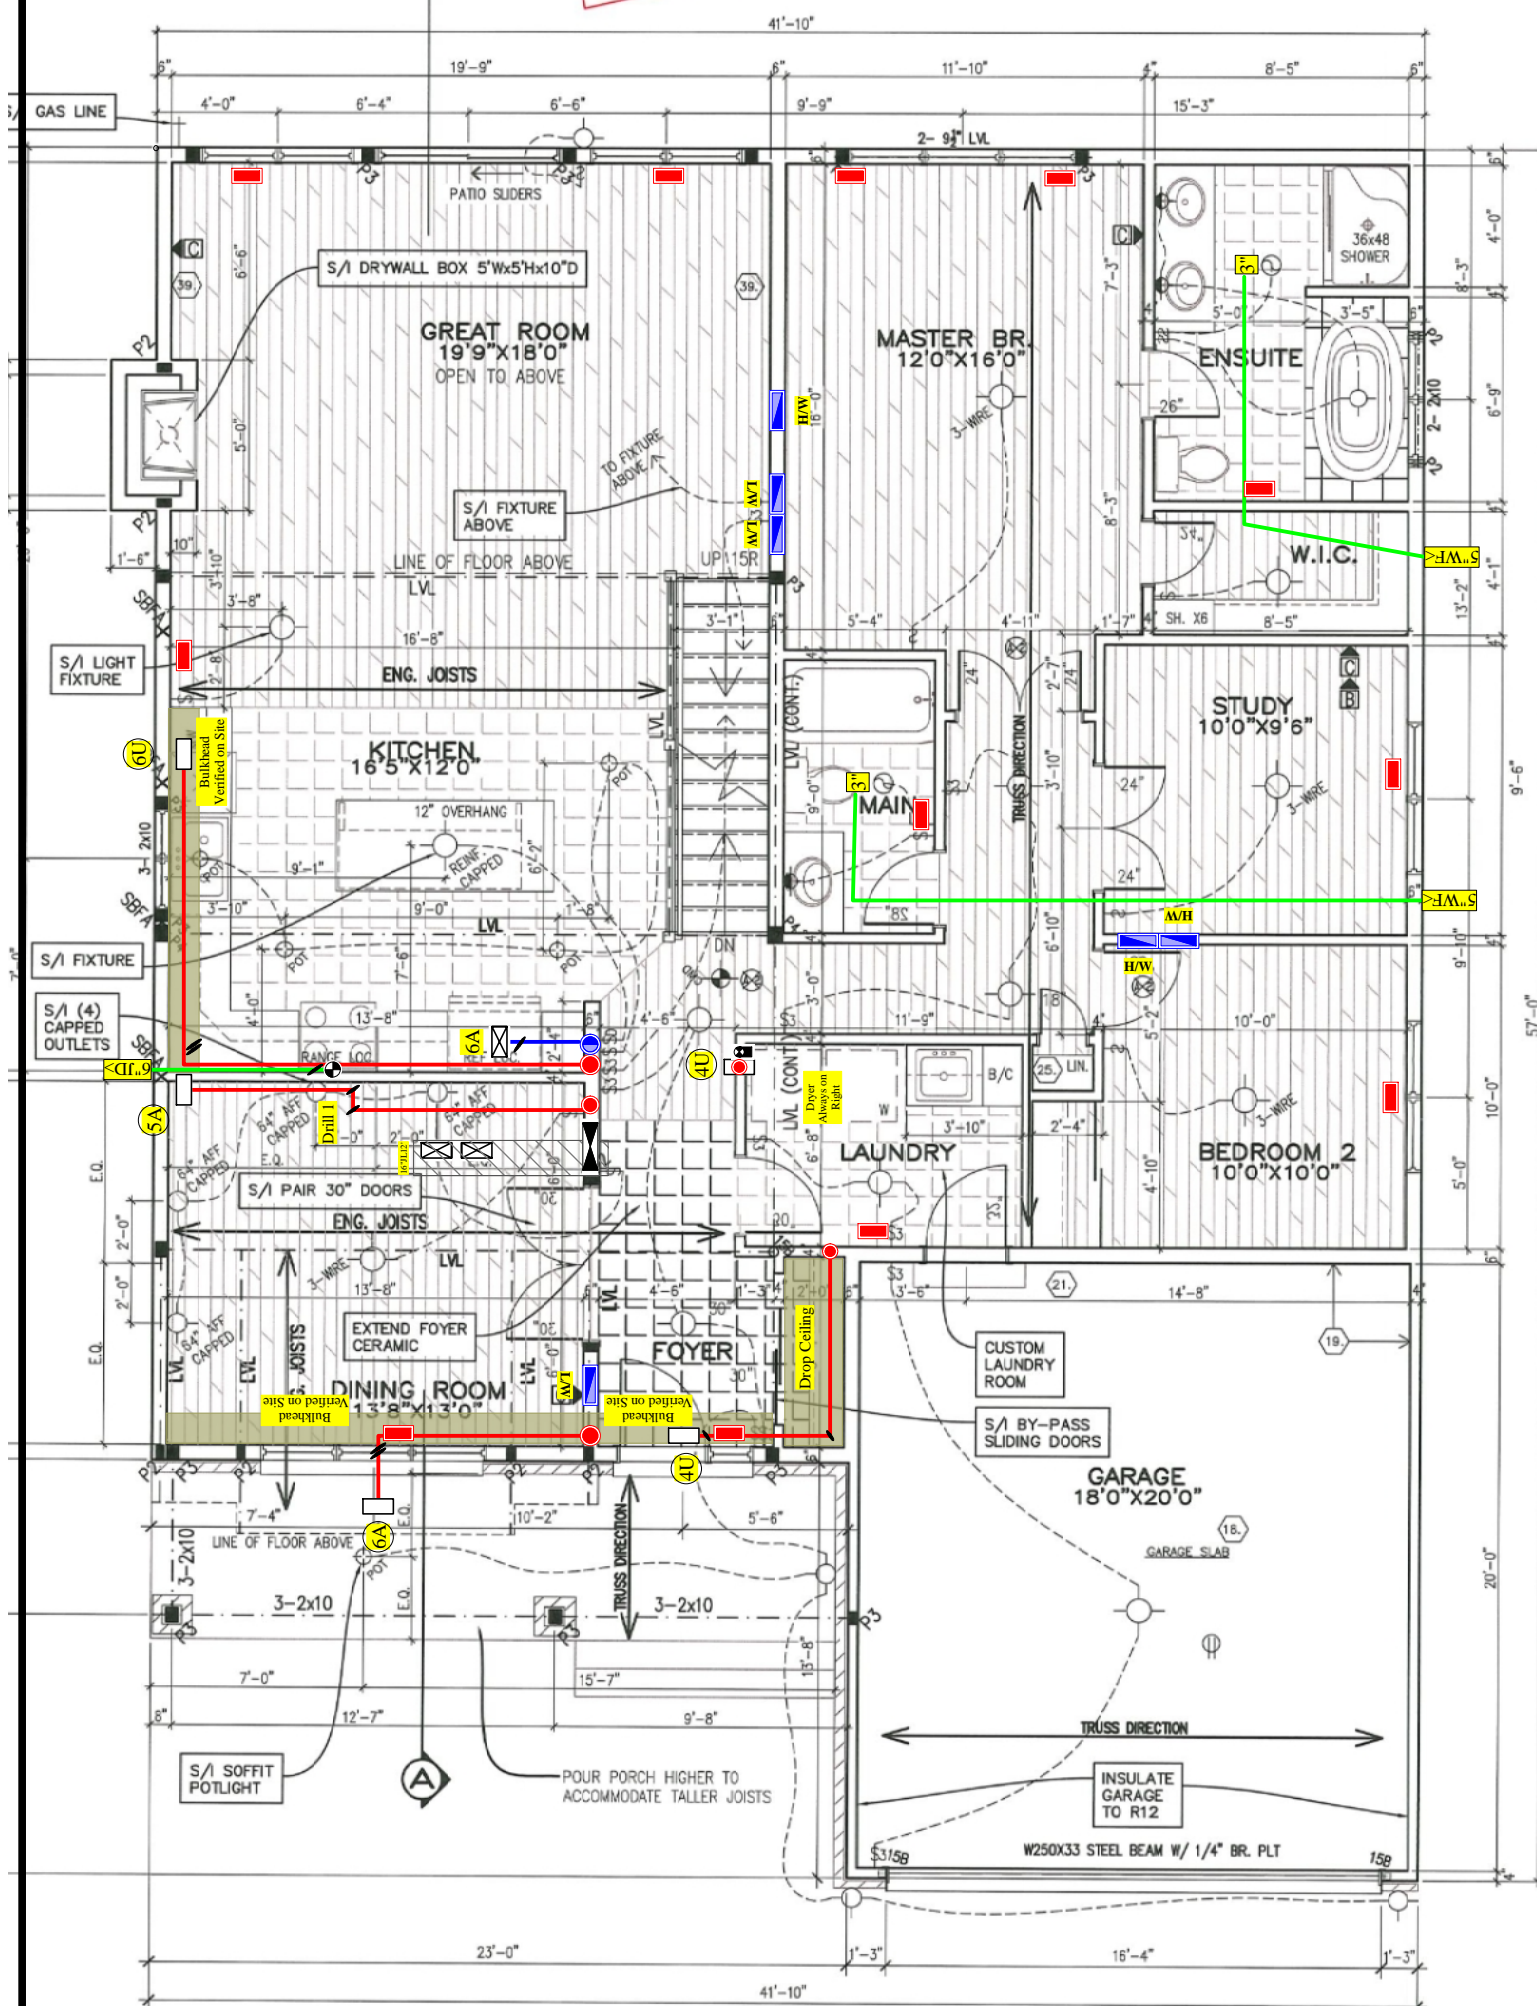


Due	Description
191106-4AR	Birchwood B-22 Loft Apt 136 PW
200408-4AK	Birchwood B-22 Loft Apt 136 PW

**\*\*NOTE\*\***

W LINTELS TO BE 2-2X10

W/ P2 POSTS ON EACH SIDE U.N.O.

Heat Loss			
Room Name	Htg cfm	Ctg cfm	Htg bu
1-BATH	8	8	0
1-BEDROOM 2	61	51	0
1-DININGROOM	75	58	0
1-ENSUITE	51	46	0
1-FOYER	54	23	0
1-GREATROOM	190	243	0
1-KITCHEN	21	230	0
1-LAUNDRY	33	13	0
1-MASTERBEDROOM	70	88	0
1-STUDY	44	49	0
1-W.I.C.	10	3	361
2-BATH	22	10	0
2-BEDROOM 3	42	31	0
2-BEDROOM 4	82	57	0
2-LOFT	63	34	0
2-STAIRS	31	8	0
2-W.I.C.	17	4	624
BASEMENT	296	44	0
	1170	1000	985

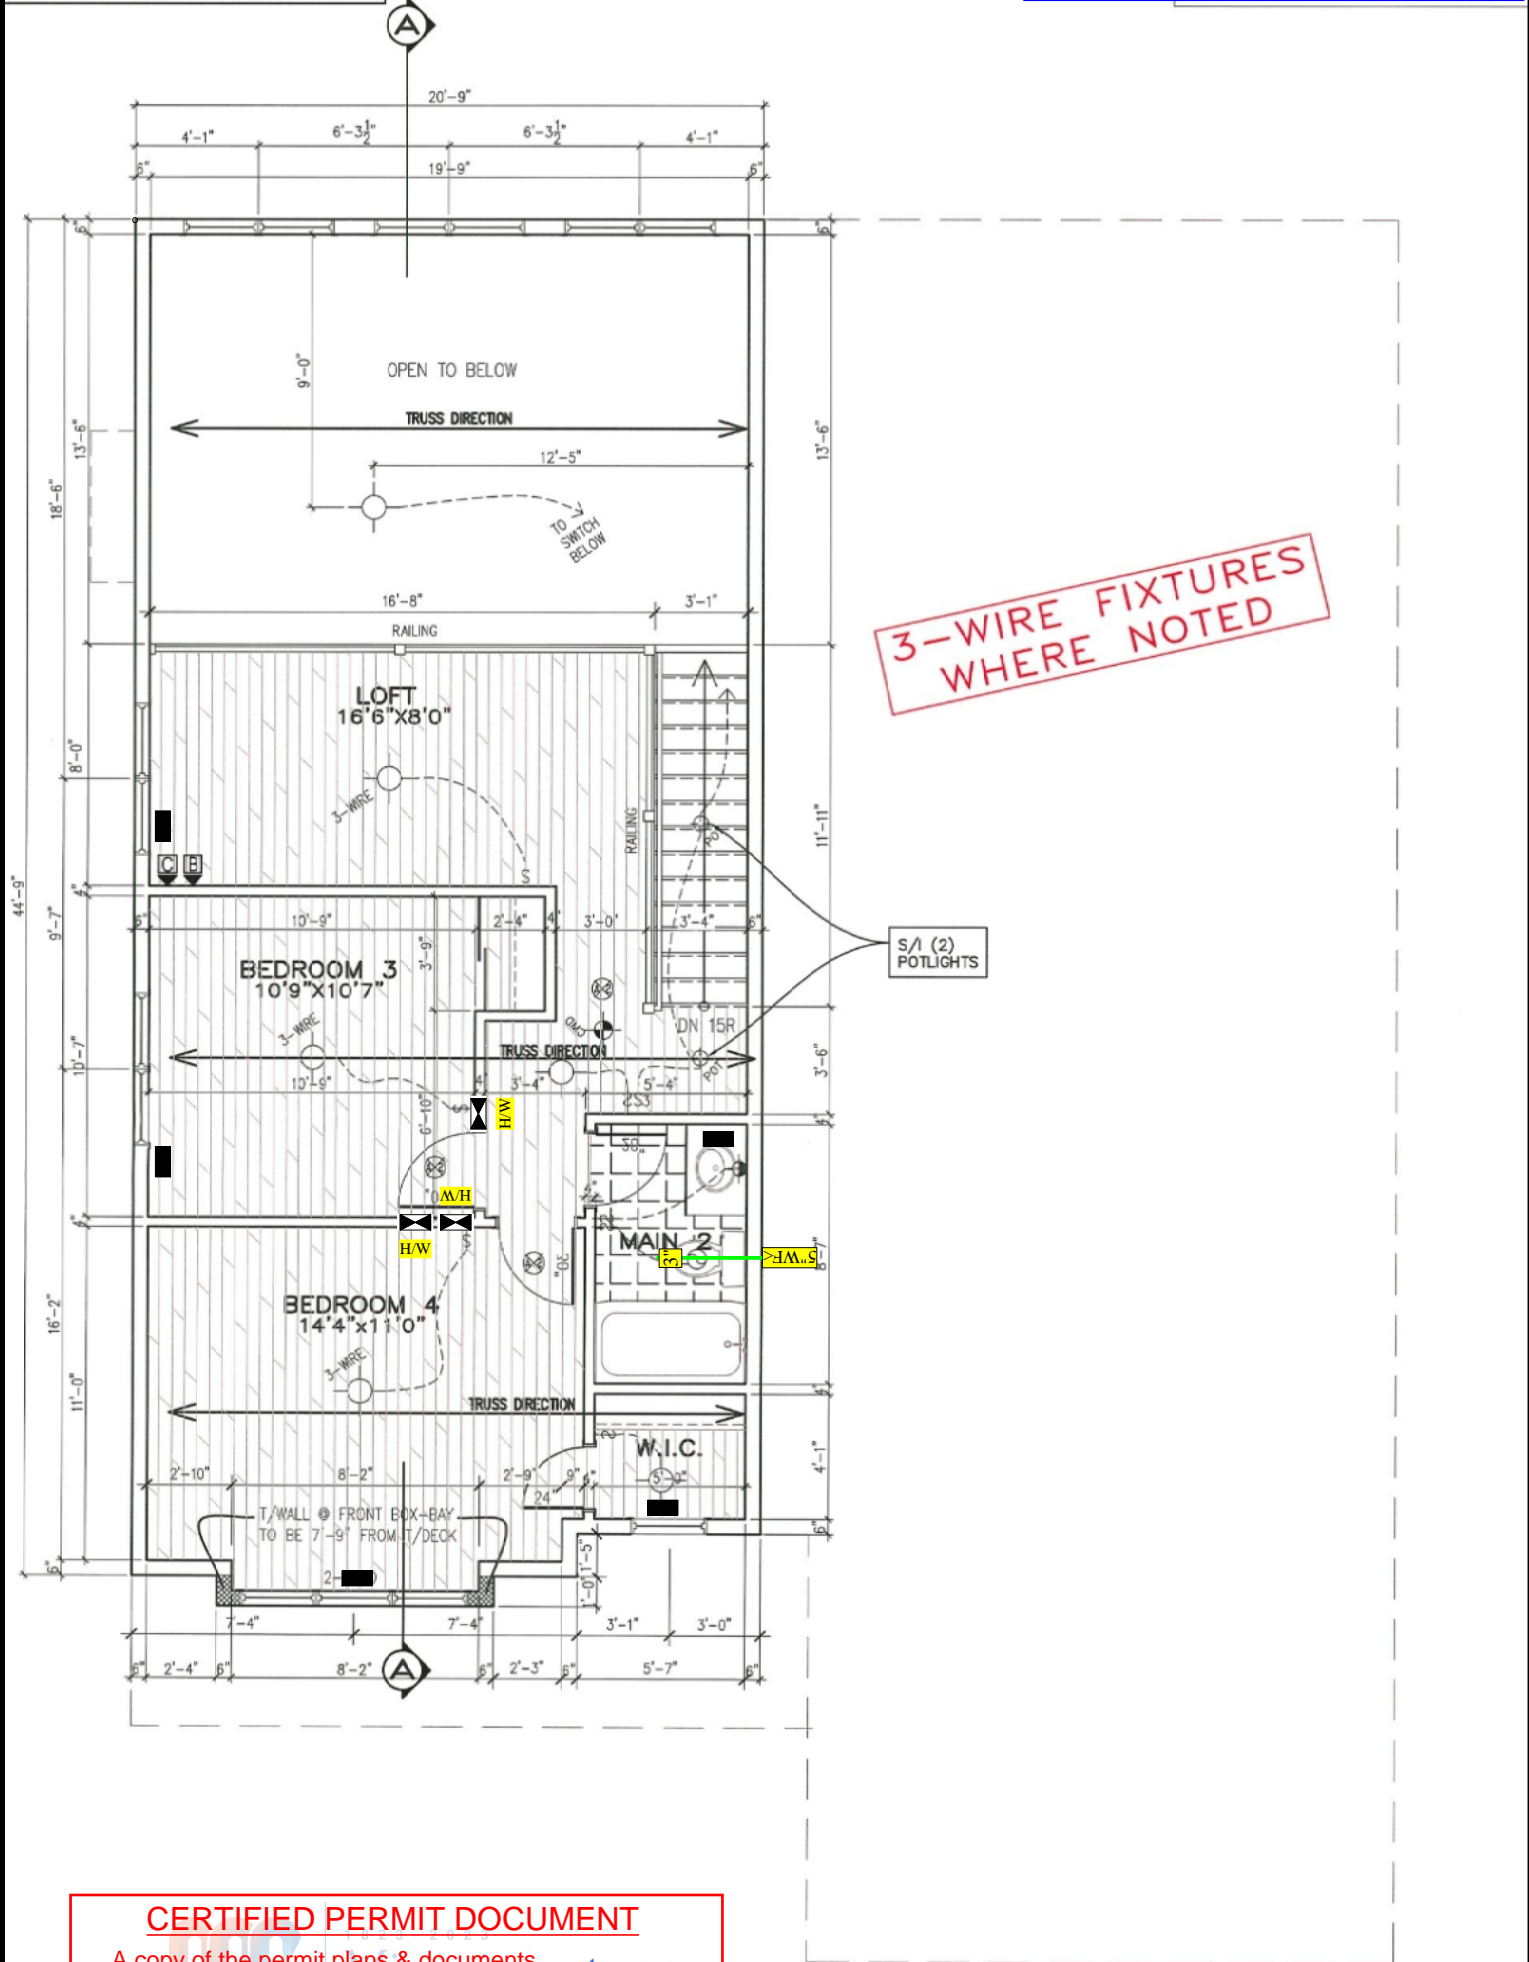

**CERTIFIED PERMIT DOCUMENT**


A copy of the permit plans & documents shall be kept & maintained on site and made available to an inspector upon request.

2023-07-06



Furn GM/EC960603BNA		
Plenum 63" & CAE 10"x23 3/4" x5	Description	
Date	1911064AR Birchwood B-22 Loft Apt 136 PW	
	200408.AK Birchwood B-22 Loft Apt 136 PW	

Heat Loss			
Room Name	Htg cfm	Clg cfm	Htg btu
1-BATH	8	8	0
1-BEDROOM 2	61	51	0
1-DININGROOM	75	58	0
1-ENSUITE	51	46	0
1-FOYER	54	23	0
1-GREATROOM	190	243	0
1-KITCHEN	21	230	0
1-LAUNDRY	33	13	0
1-MASTERBEDROOM	70	88	0
1-STUDY	44	49	0
1-W.I.C.	10	3	361
2-BATH	22	10	0
2-BEDROOM 3	42	31	0
2-BEDROOM 4	82	57	0
2-LOFT	63	34	0
2-STAIRS	31	8	0
2-W.I.C.	17	4	624
BASEMENT	296	44	0
	1170	1000	985

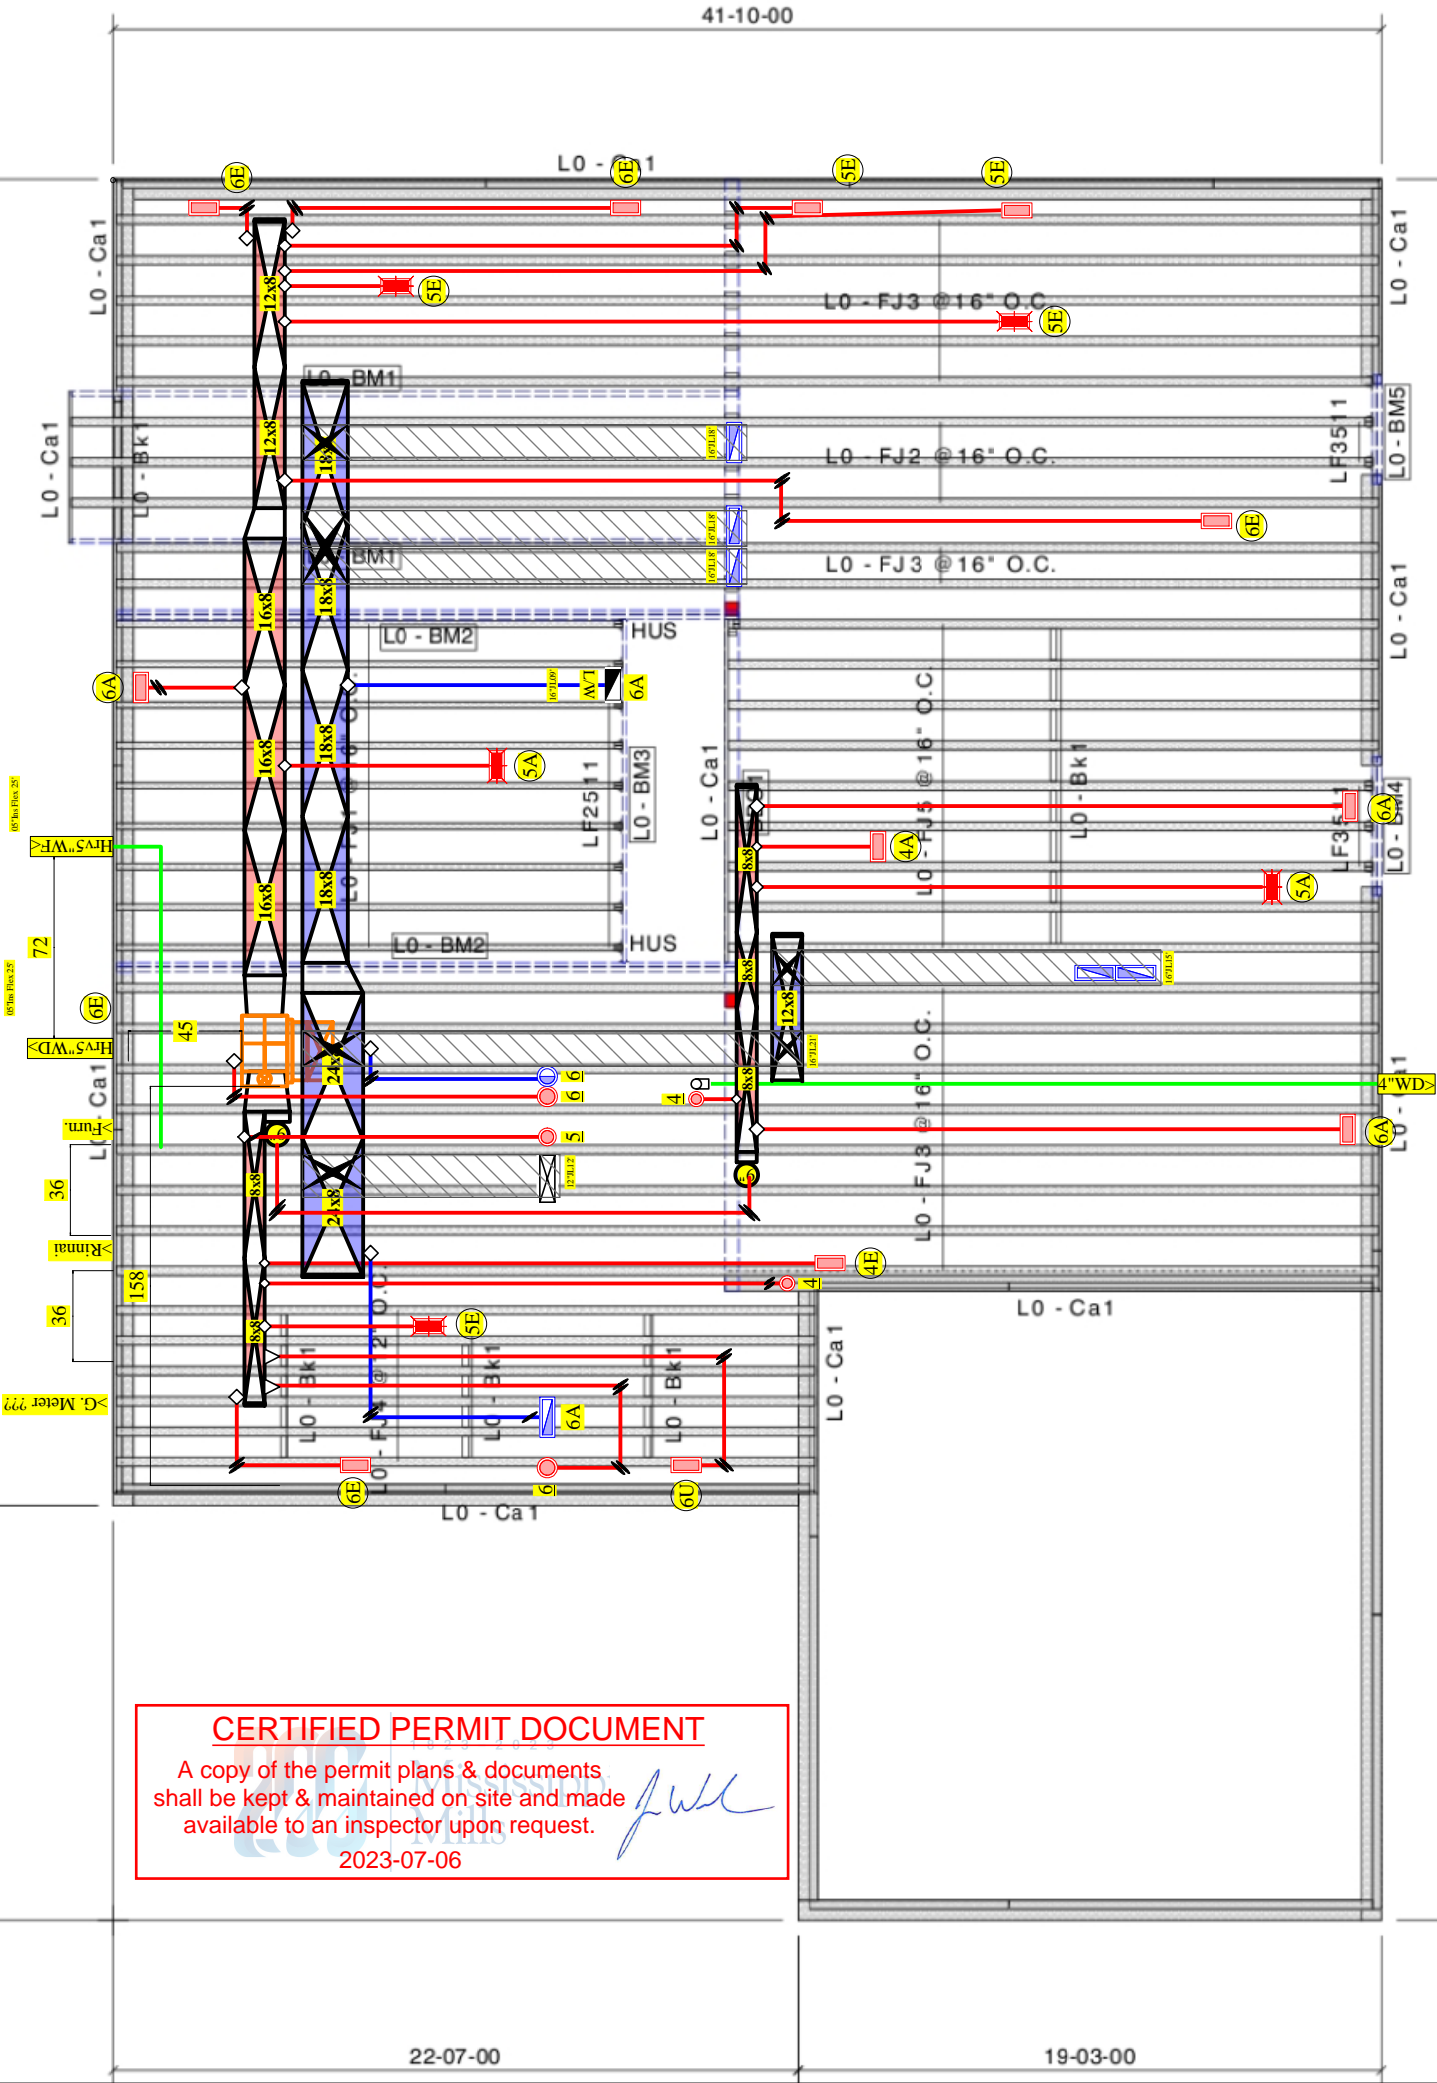

**CERTIFIED PERMIT DOCUMENT**

A copy of the permit plans & documents shall be kept & maintained on site and made available to an inspector upon request.

2023-07-06

1" = 50.84870849


Date

Description

191106:4AR Birchwood B-22 Loft Apt 136 PW

200408:AK Birchwood B-22 Loft Apt 136 PW

Heat Loss			
Room Name	Htg cfm	Clg cfm	Htg bu
1-BATH	8	8	0
1-BEDROOM 2	61	51	0
1-DININGROOM	75	58	0
1-ENSUITE	51	46	0
1-FOYER	54	23	0
1-GREATROOM	190	243	0
1-KITCHEN	21	230	0
1-LAUNDRY	33	13	0
1-MASTERBEDROOM	70	88	0
1-STUDY	44	49	0
1-W.I.C.	10	3	361
2-BATH	22	10	0
2-BEDROOM 3	42	31	0
2-BEDROOM 4	82	57	0
2-LOFT	63	34	0
2-STAIRS	31	8	0
2-W.I.C.	17	4	624
BASEMENT	296	44	0
	1170	1000	985

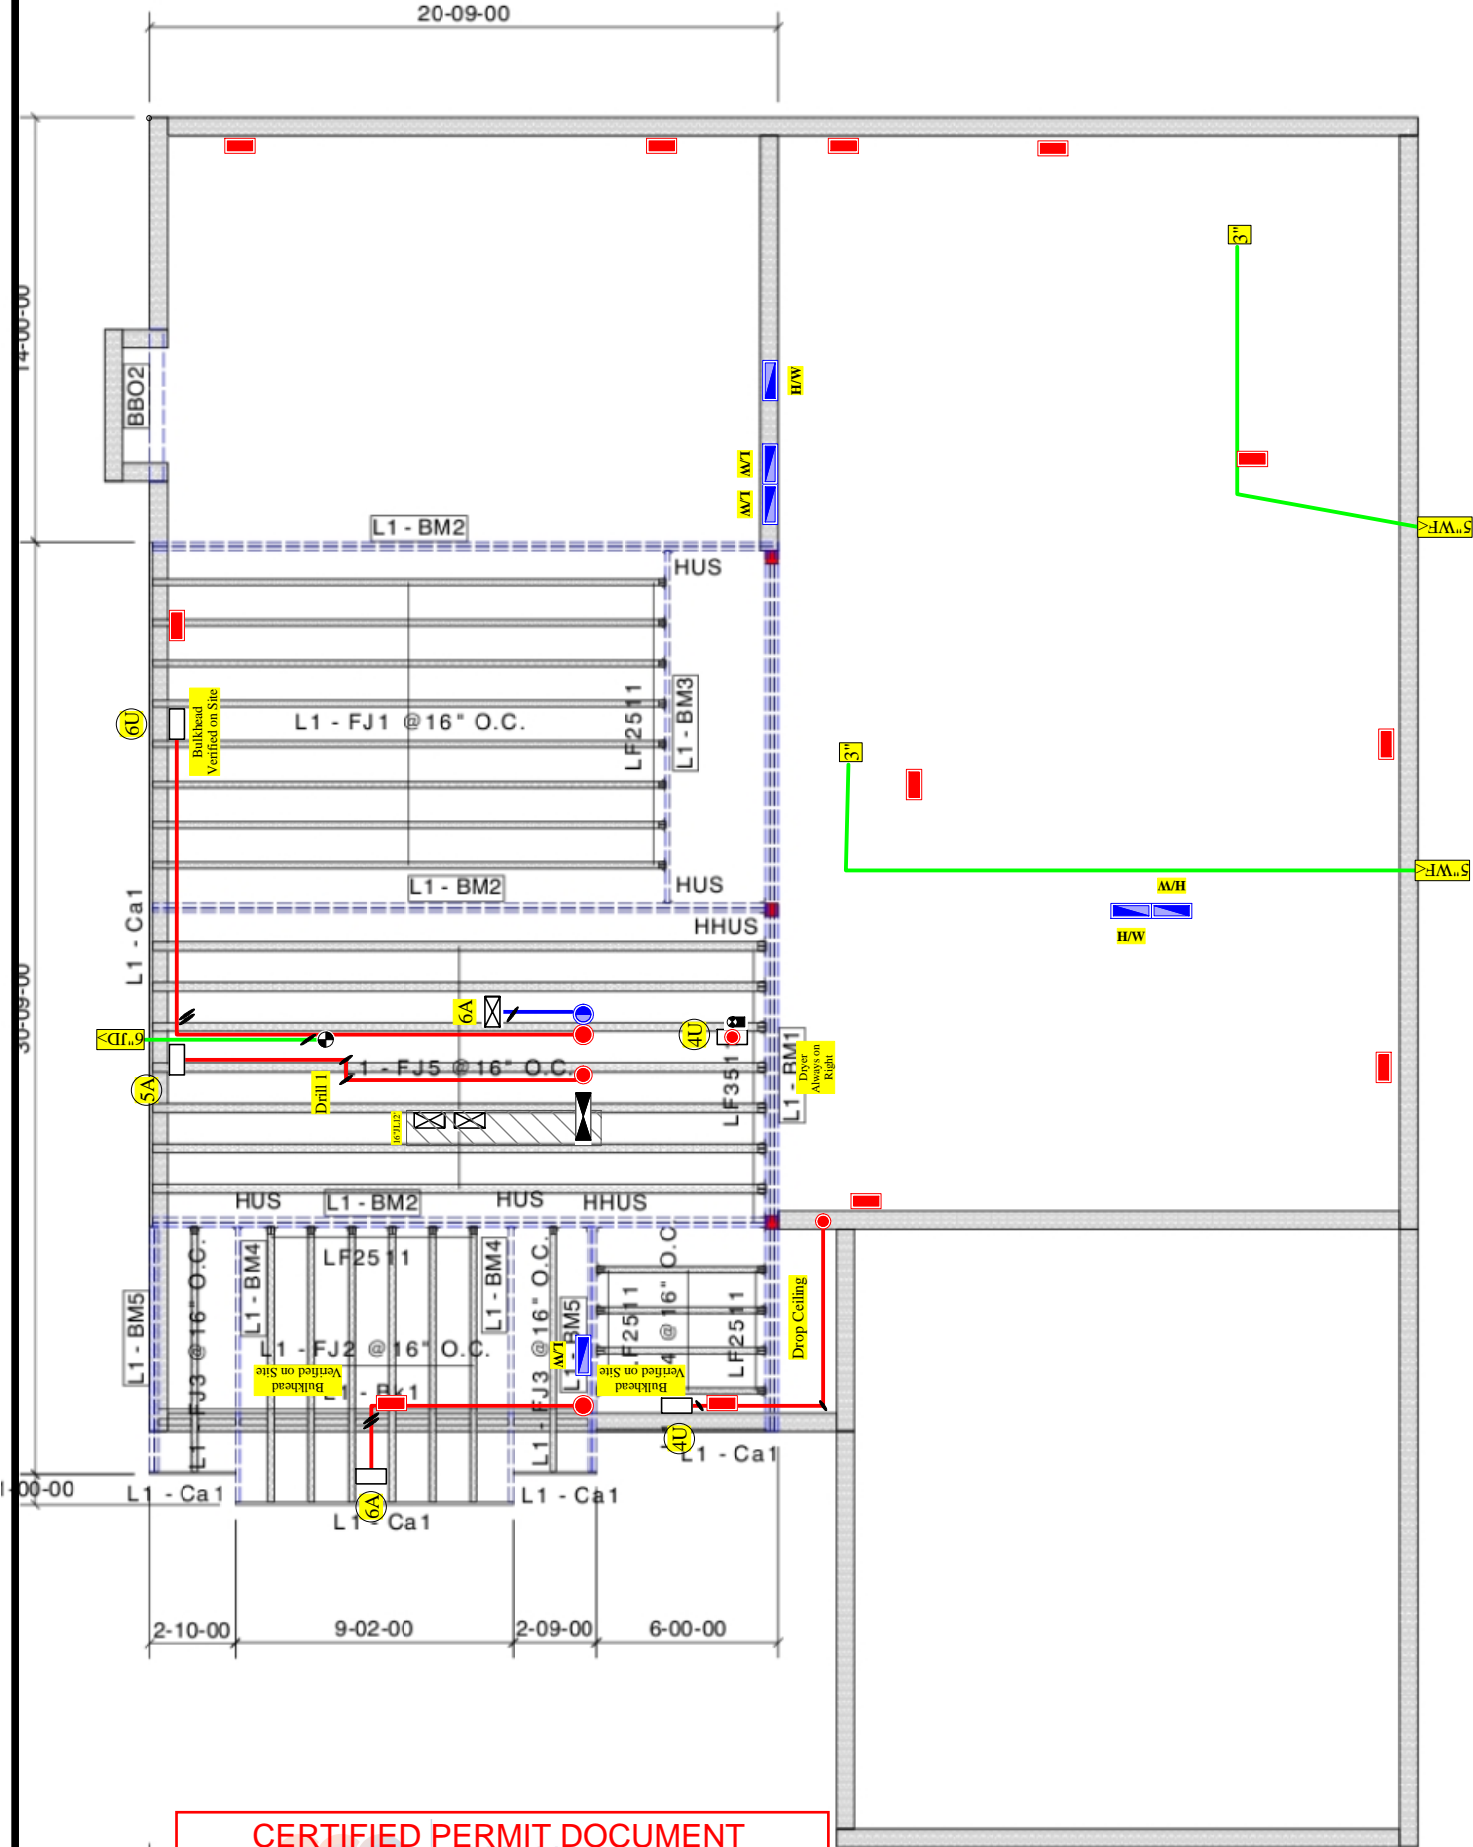


CERTIFIED PERMIT DOCUMENT

A copy of the permit plans & documents shall be kept & maintained on site and made available to an inspector upon request.


2023-07-06

Heat Loss				
Room Name	Htg cfm	Clg cfm	Htg btu	
1-BATH	8	8	0	
1-BEDROOM 2	61	51	0	
1-DININGROOM	75	58	0	
1-ENSUITE	51	46	0	
1-FOYER	54	23	0	
1-GREATROOM	190	243	0	
1-KITCHEN	21	230	0	
1-LAUNDRY	33	13	0	
1-MASTERBEDROOM	70	88	0	
1-STUDY	44	49	0	
1-W.I.C.	10	3	361	
2-BATH	22	10	0	
2-BEDROOM 3	42	31	0	
2-BEDROOM 4	82	57	0	
2-LOFT	63	34	0	
2-STAIRS	31	8	0	
2-W.I.C.	17	4	624	
BASEMENT	296	44	0	
	1170	1000	985	

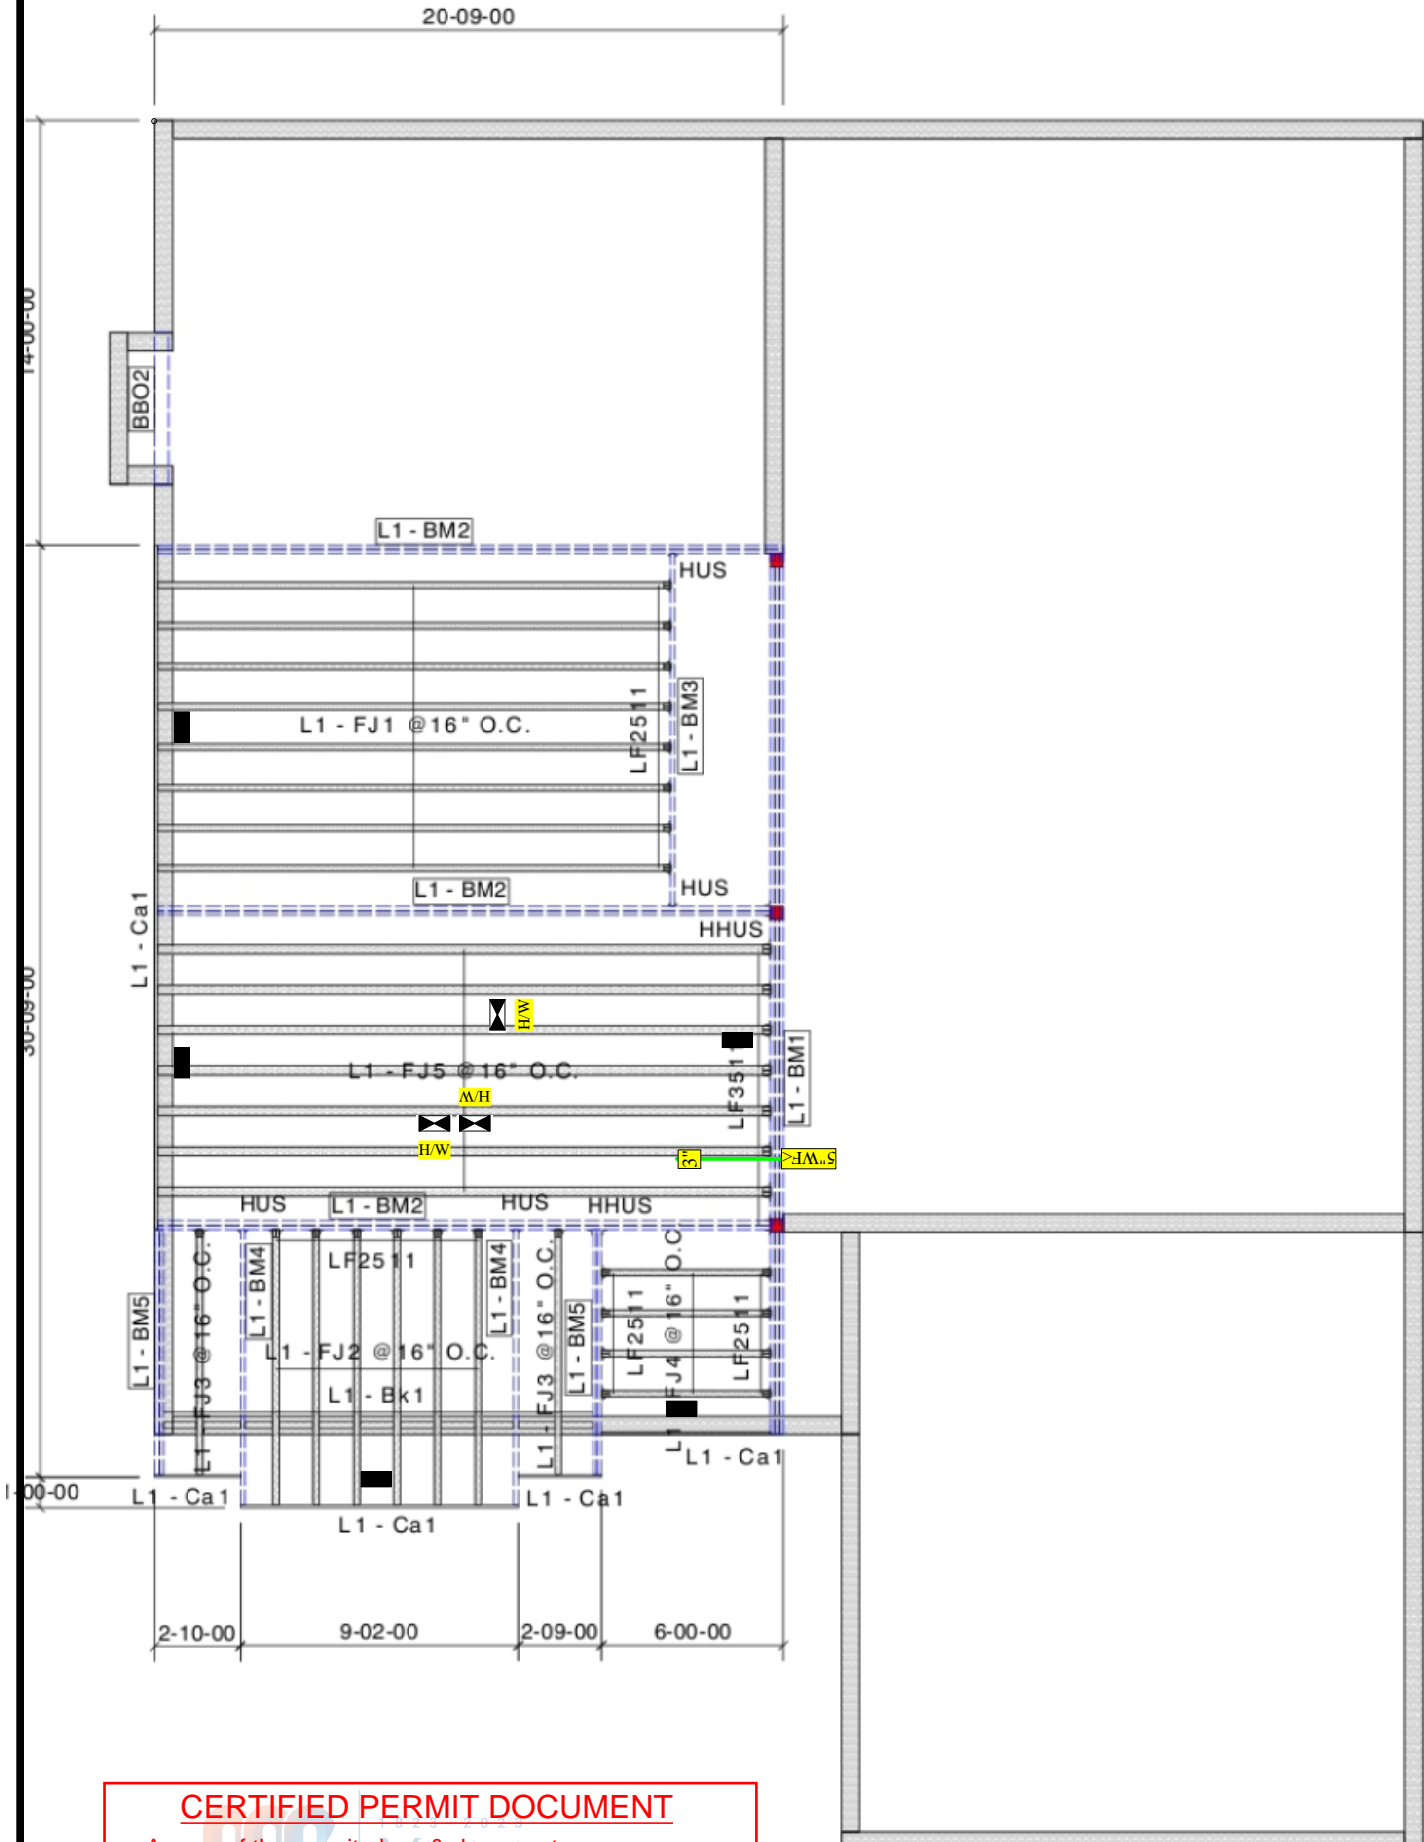

2023-07-06



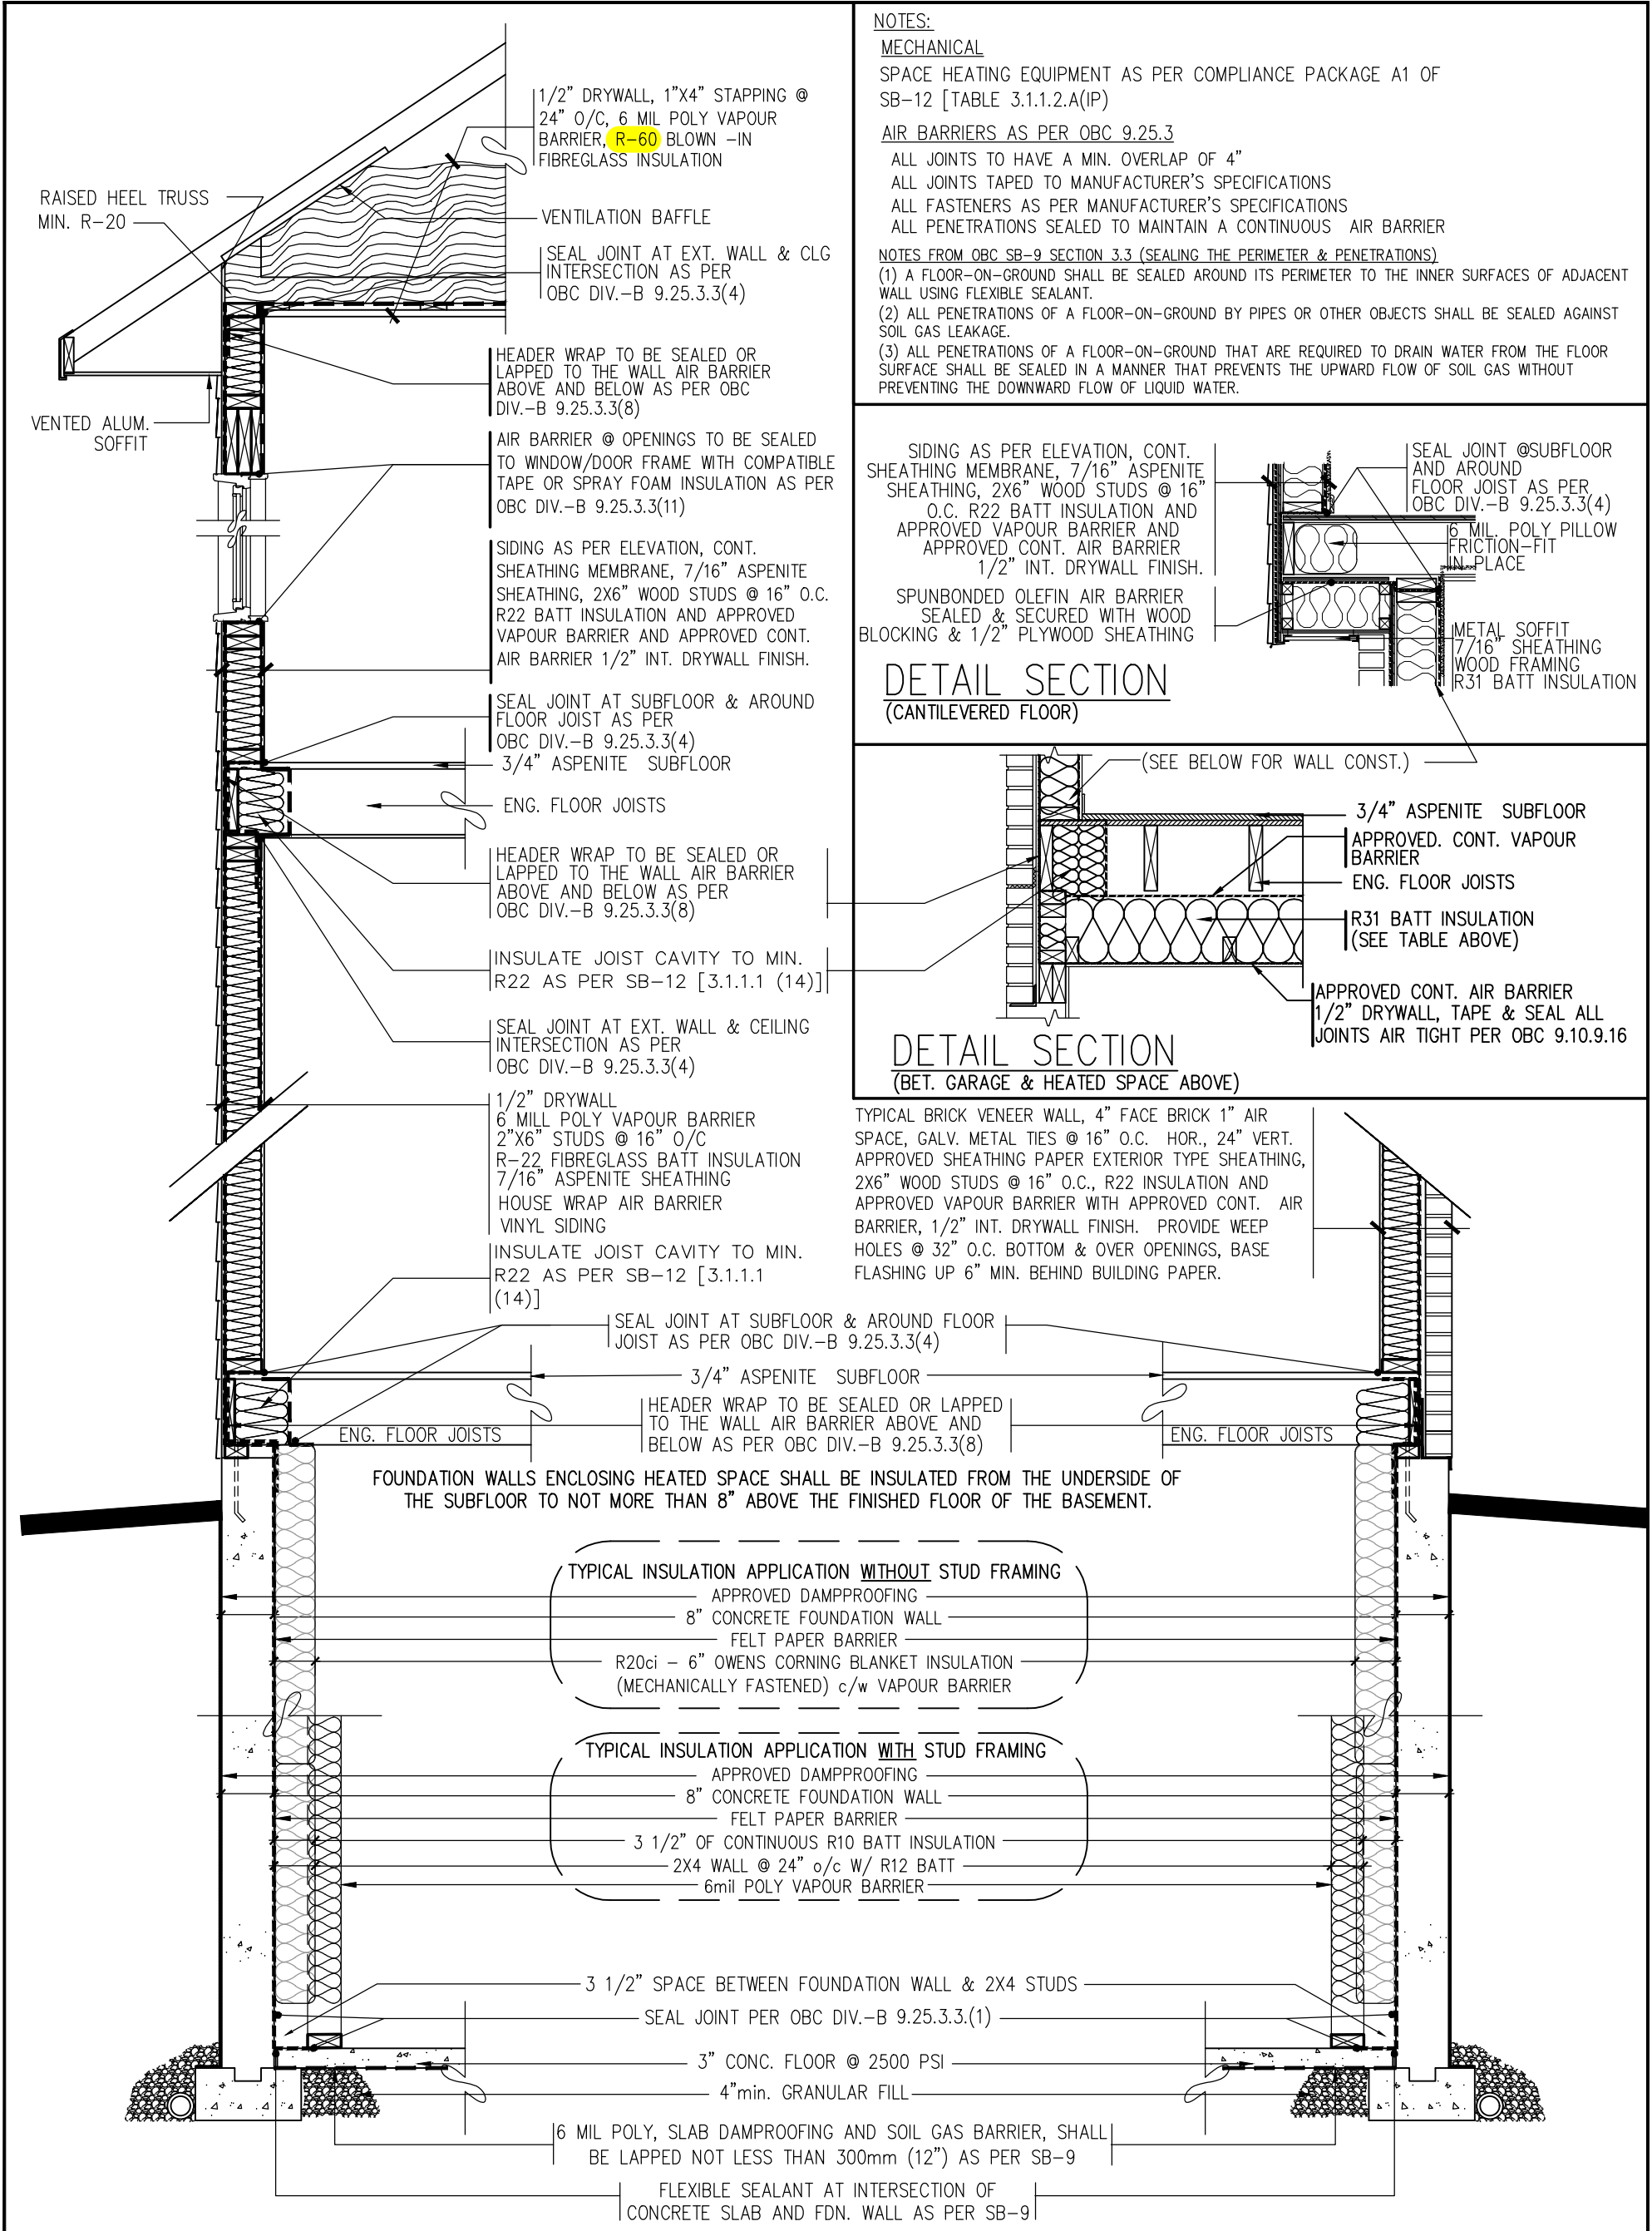

NOTES:

MECHANICAL

SPACE HEATING EQUIPMENT AS PER COMPLIANCE PACKAGE A1 OF SB-12 [TABLE 3.1.1.2.A(IP)]

AIR BARRIERS AS PER OBC 9.25.3

- ALL JOINTS TO HAVE A MIN. OVERLAP OF 4"
- ALL JOINTS TAPED TO MANUFACTURER'S SPECIFICATIONS
- ALL FASTENERS AS PER MANUFACTURER'S SPECIFICATIONS
- ALL PENETRATIONS SEALED TO MAINTAIN A CONTINUOUS AIR BARRIER

NOTES FROM OBC SB-9 SECTION 3.3 (SEALING THE PERIMETER & PENETRATIONS)

- (1) A FLOOR-ON-GROUND SHALL BE SEALED AROUND ITS PERIMETER TO THE INNER SURFACES OF ADJACENT WALL USING FLEXIBLE SEALANT.
- (2) ALL PENETRATIONS OF A FLOOR-ON-GROUND BY PIPES OR OTHER OBJECTS SHALL BE SEALED AGAINST SOIL GAS LEAKAGE.
- (3) ALL PENETRATIONS OF A FLOOR-ON-GROUND THAT ARE REQUIRED TO DRAIN WATER FROM THE FLOOR SURFACE SHALL BE SEALED IN A MANNER THAT PREVENTS THE UPWARD FLOW OF SOIL GAS WITHOUT PREVENTING THE DOWNWARD FLOW OF LIQUID WATER.

SIDING AS PER ELEVATION, CONT.  
SHEATHING MEMBRANE, 7/16" ASPENITE  
SHEATHING, 2X6" WOOD STUDS @ 16"  
O.C. R22 BATT INSULATION AND  
APPROVED VAPOUR BARRIER AND  
APPROVED CONT. AIR BARRIER  
1/2" INT. DRYWALL FINISH.

SPUNBONDED OLEFIN AIR BARRIER  
SEALED & SECURED WITH WOOD  
BLOCKING & 1/2" PLYWOOD SHEATHING

DETAIL SECTION  
(CANTILEVERED FLOOR)

SEAL JOINT @SUBFLOOR  
AND AROUND  
FLOOR JOIST AS PER  
OBC DIV.-B 9.25.3.3(4)  
6 MIL. POLY PILLLOW  
FRICTION-FIT  
IN PLACE  
METAL SOFFIT  
7/16" SHEATHING  
WOOD FRAMING  
R31 BATT INSULATION

(SEE BELOW FOR WALL CONST.)  
3/4" ASPENITE SUBFLOOR  
APPROVED. CONT. VAPOUR  
BARRIER  
ENG. FLOOR JOISTS  
R31 BATT INSULATION  
(SEE TABLE ABOVE)

DETAIL SECTION  
(BET. GARAGE & HEATED SPACE ABOVE)

TYPICAL BRICK VENEER WALL, 4" FACE BRICK 1" AIR  
SPACE, GALV. METAL TIES @ 16" O.C. HOR., 24" VERT.  
APPROVED SHEATHING PAPER EXTERIOR TYPE SHEATHING,  
2X6" WOOD STUDS @ 16" O.C., R22 INSULATION AND  
APPROVED VAPOUR BARRIER WITH APPROVED CONT. AIR  
BARRIER, 1/2" INT. DRYWALL FINISH. PROVIDE WEEP  
HOLES @ 32" O.C. BOTTOM & OVER OPENINGS, BASE  
FLASHING UP 6" MIN. BEHIND BUILDING PAPER.

FOUNDATION WALLS ENCLOSING HEATED SPACE SHALL BE INSULATED FROM THE UNDERSIDE OF  
THE SUBFLOOR TO NOT MORE THAN 8" ABOVE THE FINISHED FLOOR OF THE BASEMENT.

TYPICAL INSULATION APPLICATION WITHOUT STUD FRAMING

APPROVED DAMPPROOFING  
8" CONCRETE FOUNDATION WALL  
FELT PAPER BARRIER  
R20ci - 6" OWENS CORNING BLANKET INSULATION  
(MECHANICALLY FASTENED) c/w VAPOUR BARRIER

TYPICAL INSULATION APPLICATION WITH STUD FRAMING

APPROVED DAMPPROOFING  
8" CONCRETE FOUNDATION WALL  
FELT PAPER BARRIER  
3 1/2" OF CONTINUOUS R10 BATT INSULATION  
2X4 WALL @ 24" o/c w/ R12 BATT  
6mil POLY VAPOUR BARRIER

3 1/2" SPACE BETWEEN FOUNDATION WALL & 2X4 STUDS

SEAL JOINT PER OBC DIV.-B 9.25.3.3.(1)

3" CONC. FLOOR @ 2500 PSI


4"min. GRANULAR FILL

6 MIL POLY, SLAB DAMPROOFING AND SOIL GAS BARRIER, SHALL  
BE LAPPED NOT LESS THAN 300mm (12") AS PER SB-9

FLEXIBLE SEALANT AT INTERSECTION OF  
CONCRETE SLAB AND FDN. WALL AS PER SB-9

TYP. DETAIL SECTION (PARTIAL)  
FOR SIDING APPLICATION

TYP. DETAIL SECTION (PARTIAL)  
FOR BRICK VENEER APPLICATION



PHOENIX HOMES

SB-12 COMPLIANCE PACKAGE  
DETAILS (ALL MODELS)

CERTIFIED PERMIT DOCUMENT

A copy of the permit plans & documents  
shall be kept & maintained on site and made  
available to an inspector upon request.

2023-07-06

No.	Description	Date	By
4	SB-12 - 2022 UPDATE	JAN - 2022	SP
3	SB-12 - 2017 UPDATE	JAN - 2017	SP
2	ADDED CANTILEVERED FLOOR DETAIL	MAR28-12	TL
1	OBC SB-9 & SB-12 COMPLIANCE PACKAGE	JAN22-12	TL
REVISIONS			

footprint:

drawn by: SP


date:

scale: N/A

sheet no:

SB-12  
DETAILS



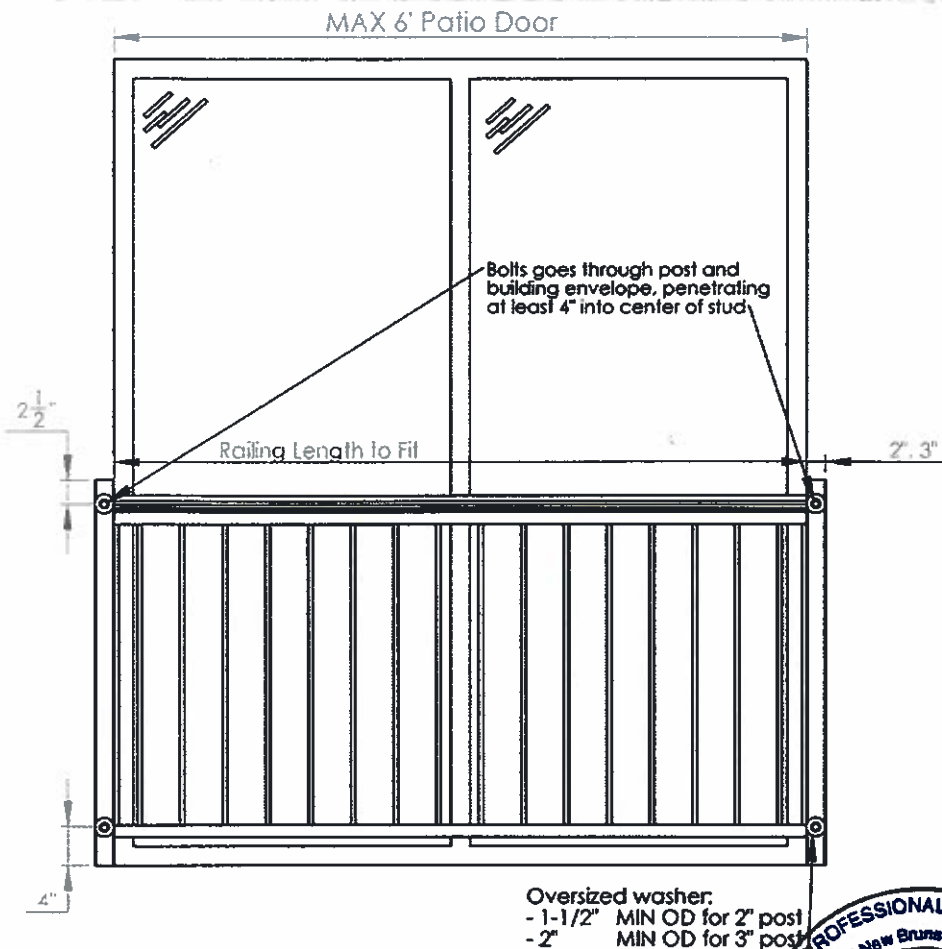

- Drilled holes into 2" post must be no larger than 9/16"  $\phi$
- Drilled holes into 3" post must be no larger than 9/16"  $\phi$

Meets the following building codes:

- NBCC 2010 (section 4.1.5.14\* - Loads on Guards, section 9.8.8 - Guards)
- Ontario 2012 (section 4.1.5.14\* - Loads on Guards, section 9.8.8 - Guards)
- \* excludes clause 1(a)



### CERTIFIED PERMIT DOCUMENT

A copy of the permit plans & documents shall be kept & maintained on site and made available to an inspector upon request.

Notes: 2023-07-06

Install anchors as per bolt manufacturer specifications

Main structure load capacity responsibility of others

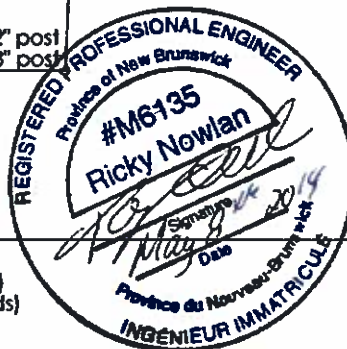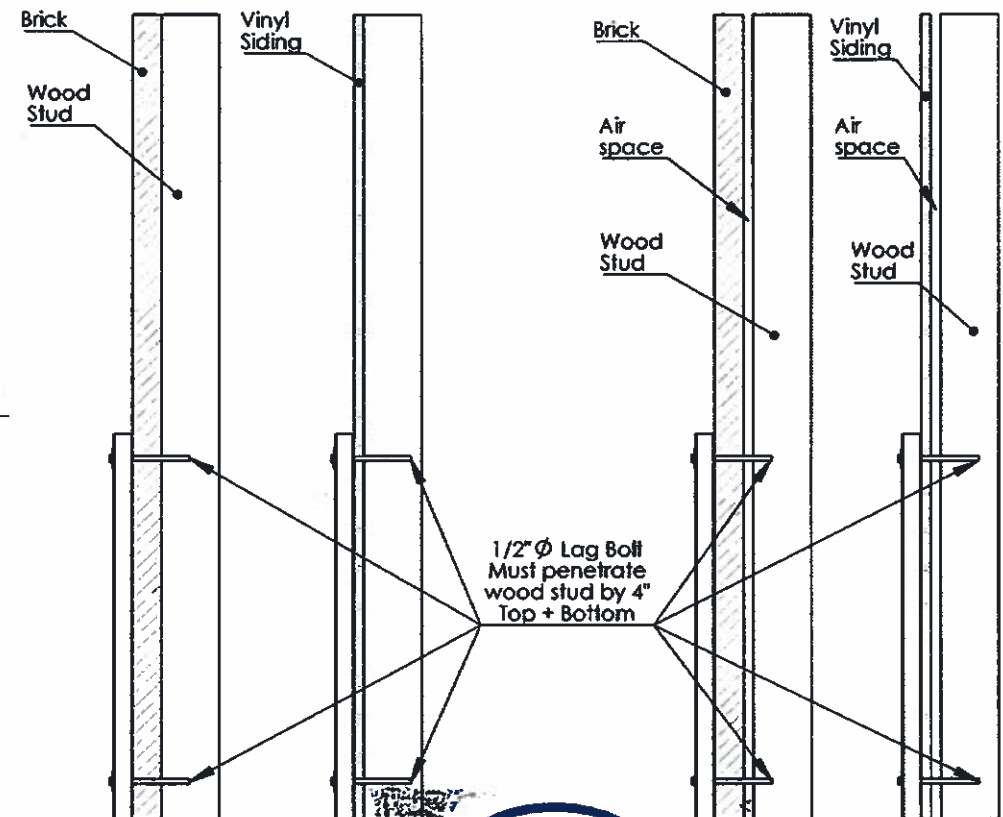

Imperial Manufacturing Group

40 Industrial Park St  
Richibucto, NB  
E4W 4A4  
Tel: 506-523-9117 Fax: 506-523-9024

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF IMPERIAL MANUFACTURING GROUP. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF IMPERIAL MANUFACTURING GROUP IS PROHIBITED.

Meets NRC ENRC NBCC 2010, OBC 2012

TITLE:

Construction Drawing  
Kool Ray Pre-Assembled  
Juliette Railing for 6'(MAX) Patio Doors

SIZE DWG. NO.  
**A** Z-KRES-004

SCALE: NTS Mar 14 SHEET 1 OF 1



**Kollaard Associates**  
Engineers

210 Prescott Street  
P.O. Box 189  
Kemptville, Ontario K0G 1J0

Civil • Geotechnical •  
Structural • Environmental •  
Hydrogeology •

**(613) 860-0923**

FAX: (613) 258-0475

May 2, 2023 (Revised)

Kollaard File # 230020 – LOT118

Phoenix Homes  
18A Bentley Avenue  
Ottawa, Ontario  
K2E 6T8

Attn: Sandy Pollock  
Tel: 613-723-9227 x 165  
Email: spollock@phoenixhomes.ca

**CERTIFIED PERMIT DOCUMENT**

A copy of the permit plans & documents  
shall be kept & maintained on site and made  
available to an inspector upon request.

2023-07-06

**Re: Proposed Single Family Dwelling, 168 Frank Fisher Crescent, Lot # 118 White Tail Ridge, Arnprior,  
Kollaard Associates File # 230020**

With regard to structural issues only, Kollaard Associates has reviewed the following drawings:

- Phoenix Homes, Lot # 118 White Tail Ridge, Pages # 1, 2C to 9C, Dated 02/05/2023
- Grandor Lumber Inc., Roof Truss Layout, Birchwood Loft - C, Dated 12/16/2021
- Grandor Lumber Inc., 2<sup>nd</sup> Floor Joist Layout, LOT WTR3-118, Dated 05/02/2023
- Grandor Lumber Inc., 1<sup>st</sup> Floor Joist Layout, LOT WTR3-118, Dated 05/02/2023

Kollaard Associates offers the following comments:

**Second Floor Plan – Pages # 4:**

1. It is the opinion of Kollaard Associates that the proposed beams, lintels and built-up wood posts shown on Phoenix Homes Pages # 4 are adequate.
2. The proposed tall wall noted on Phoenix Homes Sheet # 1 is adequate.
3. Truss design is by others.

**Ground Floor Plan – Pages # 3:**

4. It is the opinion of Kollaard Associates that the proposed lintels, beams and supporting posts shown on Phoenix Homes Sheets # 3 are adequate.
5. Ramset a 2x6 to the top flange of all steel beams to attach the above framing, floor joists and flush LVL beams.
6. Truss design is by others.



**Professional Engineers**  
Ontario

Authorized by the Association of Professional Engineers  
of Ontario to offer professional engineering services.



7. Floor joist design and flush LVL beams within the floor structure are by the manufacturer.

Basement Plan – Pages # 2:

8. It is the opinion of Kollaard Associates that the proposed steel beams, steel posts, lintels (not specified on the floor joist layout) built-up wood posts shown on Phoenix Homes Pages # 2 are adequate.
9. The front porch slab reinforcement described on Phoenix Homes Pages # 1 is adequate.
10. The proposed foundation walls conform to 2012 OBC Table 9.15.4.2.A.
11. The strip footings and proposed interior pad footings shown on Phoenix Homes Page # 2 and noted on Phoenix Homes Page # 1 are adequate.
12. Floor joist design, flush LVL beams within the floor structure and LVL lintels are by the manufacturer. The posts supporting the flush LVL lintels/beams shown on Phoenix Homes Pages # 2 are adequate.

General Notes:

13. All gravity loads to be carried to foundation through solid blocking.
14. Truss design is by others.
15. Floor joist design, flush LVL beams within the floor structure and LVL lintels are by the manufacturer.
16. The self supporting stairs are to be designed by the stair manufacturer.
17. All dimension lumber, except non-load bearing 8 ft 2x6 studs to be No.2 grade SPF or better.
18. Non-load bearing 8 ft 2x6 studs to be No.3 or Stud grade SPF or better.
19. All guards to be as per OBC SB-7, unless otherwise mentioned or designed by others.
20. All brick lintels to be as per OBC Table 9.20.5.2.B.
21. Unless otherwise noted, LVL to be 1.8E 3000Fb LVL (Canadian Limit States bending strength of at least 39.5 MPa) with 1 $\frac{3}{4}$ " nominal width or better.
22. Pemco Steel adjustable posts are designed and approved by the manufacturer. The adjustable steel posts are designed for a maximum allowable load of 106.8 kN at a maximum height of 9'-3".
23. All 3" x 3" x 3/16" HSS posts c/w 6" x 6" x 3/8" top and bottom bearing plates.
24. The assumed soil bearing resistance of 100 kPa is to be verified prior to construction.
25. Note that the truss manufacturer/floor joist supplier has sized the flush LVL beams and girder trusses shown on the building drawings. The comments provided by Kollaard Associates in this report are based in part on the design indicated in the truss and floor layouts. If a different truss and/or floor layout is used in construction, comments made in this report may no longer be valid. Provide Kollaard Associates with the full truss package prior to construction.
26. Comments provided in this report are made in consideration of Part 9 and Part 4 (where applicable) of the 2012 OBC as amended.

27. This report constitutes a review of the structural information indicated on the building plans cited in this report for the client indicated above.

We trust this letter provides sufficient information for your present purposes. If you have any questions concerning this letter please do not hesitate to contact our office.

Sincerely,  
Kollaard Associates Inc.



Christopher Cogliati, P.Eng.

### **CERTIFIED PERMIT DOCUMENT**

A copy of the permit plans & documents shall be kept & maintained on site and made available to an inspector upon request.

2023-07-06

