SB-12 ENERGY EFFICIENCY DESIGN MATRIX

PRESCRIPTIVE COMPLIANCE SB-12 (SECTION 3.1.1) TABLE 3.1.1.2.A

PACKAGE A1

| SPACE REATING FUEL | | | | | | |
|--------------------|--------------|--|--|--|--|--|
| ■ GAS | □ OIL | | | | | |
| □ ELECTRIC | □ PROPANE | | | | | |
| □ EARTH | □ SOLID FUEL | | | | | |

| BUILDING COMPONENT | REQUIRED | PROPOSED |
|---|-------------------|-------------------|
| INSULATION RSI (R) VALUE | | |
| CEILING W/ ATTIC SPACE | 10.56 (R60) | 10.56 (R60) |
| CEILING W/O ATTIC SPACE | 5.46 (R31) | 5.46 (R31) |
| EXPOSED FLOOR | 5.46 (R31) | 5.46 (R31) |
| WALLS ABOVE GRADE | 3.87 (R22) | 3.87 (R22) |
| BASEMENT WALLS | 3.52 ci 🔸 | 3.52 ci |
| * PROPOSED VALUES MAY BE SUBSTITUTED W/ 2.11+1.76ci (R12+R10ci) | (R20 ci) ^ | (R20 ci) ^ |
| BELOW GRADE SLAB ENTIRE SURFACE > 600mm BELOW GRADE | - | - |
| EDGE OF BELOW GRADE SLAB ≤ 600mm BELOW GRADE | 1.76 (R10) | 1.76 (R10) |
| HEATED SLAB OR SLAB ≤ 600mm BELOW GRADE | 1.76 (R10) | 1.76 (R10) |
| WINDOWS & DOORS | | |
| WINDOWS/SLIDING GLASS DOORS (MAX U-VALUE) | 1.6 | 1.6 |
| SKYLIGHTS (MAX. U-VALUE) | 2.8 | 2.8 |
| APPLIANCE EFFICIENCY | | |
| SPACE HEATING EQUIP. (AFUE%) | 96% | 96% |
| HRV EFFICIENCY (%) | 75% | 75% |
| DHW HEATER (EF) | 0.8 | 0.8 |

AREA CALCULATIONS EL. 'A' OPT. EL. 'A' EL. 'B' OPT. EL. 'B' STD. PLAN STD. PLAN STD. PLAN STD. PLAN 970.78 sq. ft. GROUND FLOOR AREA 970.78 sq. ft. 970.78 sq. ft. SECOND FLOOR AREA 1168.08 sq. ft. 1156.42 sq. ft. 1168.08 sq. ft. 1156.42 sq. ft. 2139 sq. ft. SUBTOTAL 2127 sq. ft. 2139 sq. ft. 2127 sq. ft. DEDUCT ALL OPEN AREAS 12 sq. ft. 12 sq. ft. 12 sq. ft. 2127 sq. ft. 2115 sq. ft. 2127 sq. ft. 2115 sq. ft. TOTAL NET AREA $(197.59\; sq.\; m.)\;\; (196.51\; sq.\; m.)\;\; (197.59\; sq.\; m.)\;\; (196.51\; sq.\; m.)$ 0 sq. ft. 0 sa. ft. 0 sg. ft. 0 sa. ft. FINISHED BASEMENT 1199.75 sq. ft. 1190.75 sq. ft. 1199.75 sq. ft. 1199.75 sq. ft. COVERAGE W/OUT PORCH (111.46 sq. m.) (110.62 sq. m.) (111.46 sq. m.) (111.46 sq. m.)

| W/ PORCH | (119.37 sq. m.) | (118.29 sq. m.) | (119.37 sq. m.) | (117.41 sq. m.) |
|---------------------------------|-----------------|-----------------|-----------------|-----------------|
| WINDOW / WALL AREA | EL. A | EL. A | EL. B | EL. B |
| CALCULATIONS | STD. PLAN | OPT. PLAN | STD. PLAN | OPT. PLAN |
| | 3161.50sq. ft. | 3197.83 sq. ft. | 3161.50 sq. ft. | 3197.83 sq. ft. |
| GROSS WALL AREA | (293.71 sq. m.) | (297.09 sq. m.) | (293.71 sq. m.) | (297.09 sq. m.) |
| GROSS WINDOW AREA | 179 sq. ft. | 193.52 sq. ft. | 181 sq. ft. | 189.52 sq. ft. |
| (INCL. GLASS DOORS & SKYLIGHTS) | (16.63 sq. m.) | (17.98 sq. m.) | (16.82 sq. m.) | (17.61 sq. m.) |
| TOTAL WINDOW % | 5.66 % | 6.05 % | 5.73 % | 5.93 % |

1284.92 sq. ft.1273.25 sq. ft.1284.92 sq. ft.1263.75 sq. ft.

- 1 TITLE PAGE
- 2 BASEMENT PLAN, EL. 'A'
- 3 GROUND FLOOR PLAN, EL. 'A'
- 4 SECOND FLOOR PLAN, EL. 'A'
- 5 OPTIONAL SECOND FLOOR PLAN, EL. 'A'
- 6 BASEMENT PLAN, EL. 'B'
- 7 GROUND FLOOR PLAN, EL. 'B'
- 8 SECOND FLOOR PLAN, EL. 'B'
- 9 OPTIONAL SECOND FLOOR PLAN, EL. 'B'
- 10 PART. OPTIONAL FLOOR PLANS, EL. 'A' & 'B'
- 11 FRONT & REAR ELEVATION 'A' & 'B'
- 12 SIDE ELEVATION 'A'
- 13 OPTIONAL SIDE ELEVATION 'A'
- 14 FRONT ELEVATION 'B'
- 15 SIDE ELEVATION 'B'
- 16 OPTIONAL SIDE ELEVATION 'B'
- 17 LOOK OUT DECK CONDITION
- 18 CROSS SECTION 'A-A'
- 19 CONSTRUCTION NOTES 1
- 20 CONSTRUCTION NOTES 2



STAMP FOR STRUCTURAL ONLY, NOT INCLUDING PRE-ENGINEERED ROOF OR FLOOR SYSTEMS



| 7. ISSUED FOR FINAL APPROVAL | 2019/05/17 | DS |
|--|-------------------|----|
| 6. REVISED AS PER STRUCTURAL ENGINEER COMMENTS | 2018/08/08 N | MM |
| 5. COORDINATED PLANS W/ FLOOR LAYOUTS AS PER MANUF. | 2019/04/25 E | BB |
| 4. COORDINATED PLANS W/ ROOF TRUSS LAYOUTS AS PER MA | NUF. 2019/04/25 E | BB |
| 3. REVISED AS PER ARCHITECTURAL CONTROL COMMENTS | 2019/04/25 E | BB |
| 2. REVISED AS PER CLIENT COMMENTS | 2018/02/13 N | MM |
| 1. ISSUED FOR CLIENT REVIEW & PRICING | 2018/01/17 N | MM |
| REVISIONS | DATE (YYYY/MM/DD) | BY |
| | | |

TITLE PAGE

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.

COVERAGE W/ PORCH

OUT IN THE ONLARIO BUILDING CODE TO BE A DESIGNER.
QUALIFICATION INFORMATION

DEREK SANTOS

NAME SIGNATURE BCIN
REGISTRATION INFORMATION


HUNT UUD DESIGN ASSOCIATES INC.

ROYAL PINE HOMES-FORESTSIDE ESTATES PH2 - 215044 UNIT 2202 - T2
"MANOR OF CLAIREVILLE", BRAMPTON, ONT. REV.2019.05.17


 Drawn By
 Checked By
 Scale
 File Number
 File Number
 Page Number


 NS
 MM/DS
 3/16"=1'-0"
 215044WS2202.T2.DWG
 1
 of 20


 8966 Woodbine Ave, Markham, ON L3R 0J7
 T 905.737.5133
 F 905.737.7326

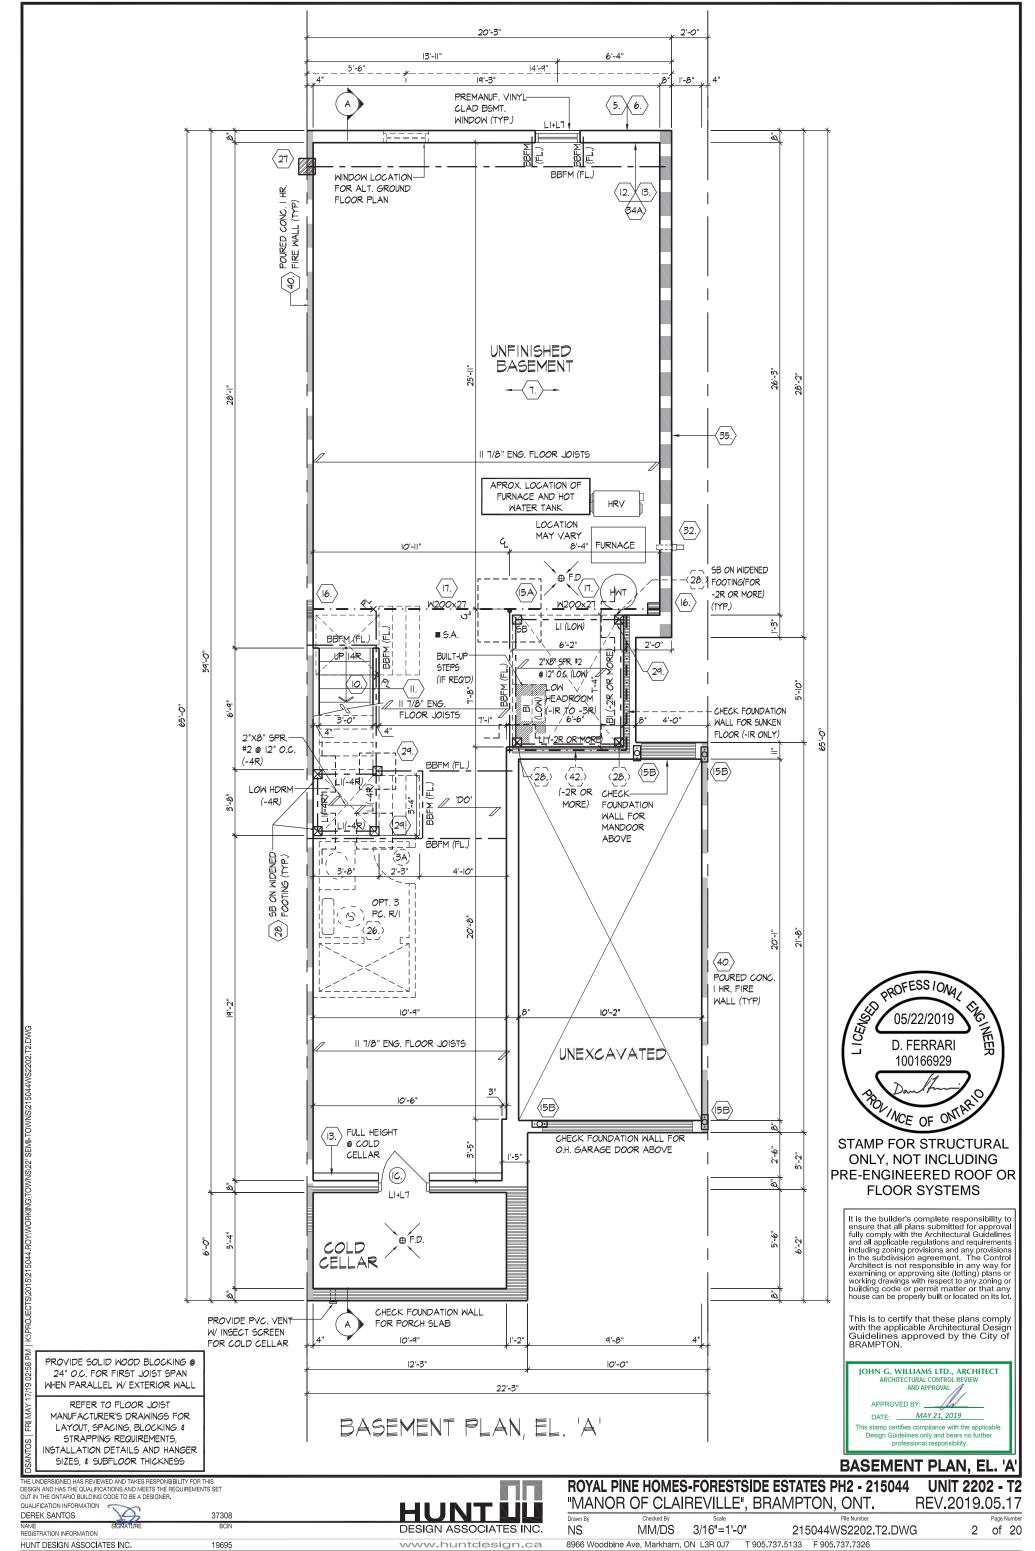



All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BOIN number and original signature.)

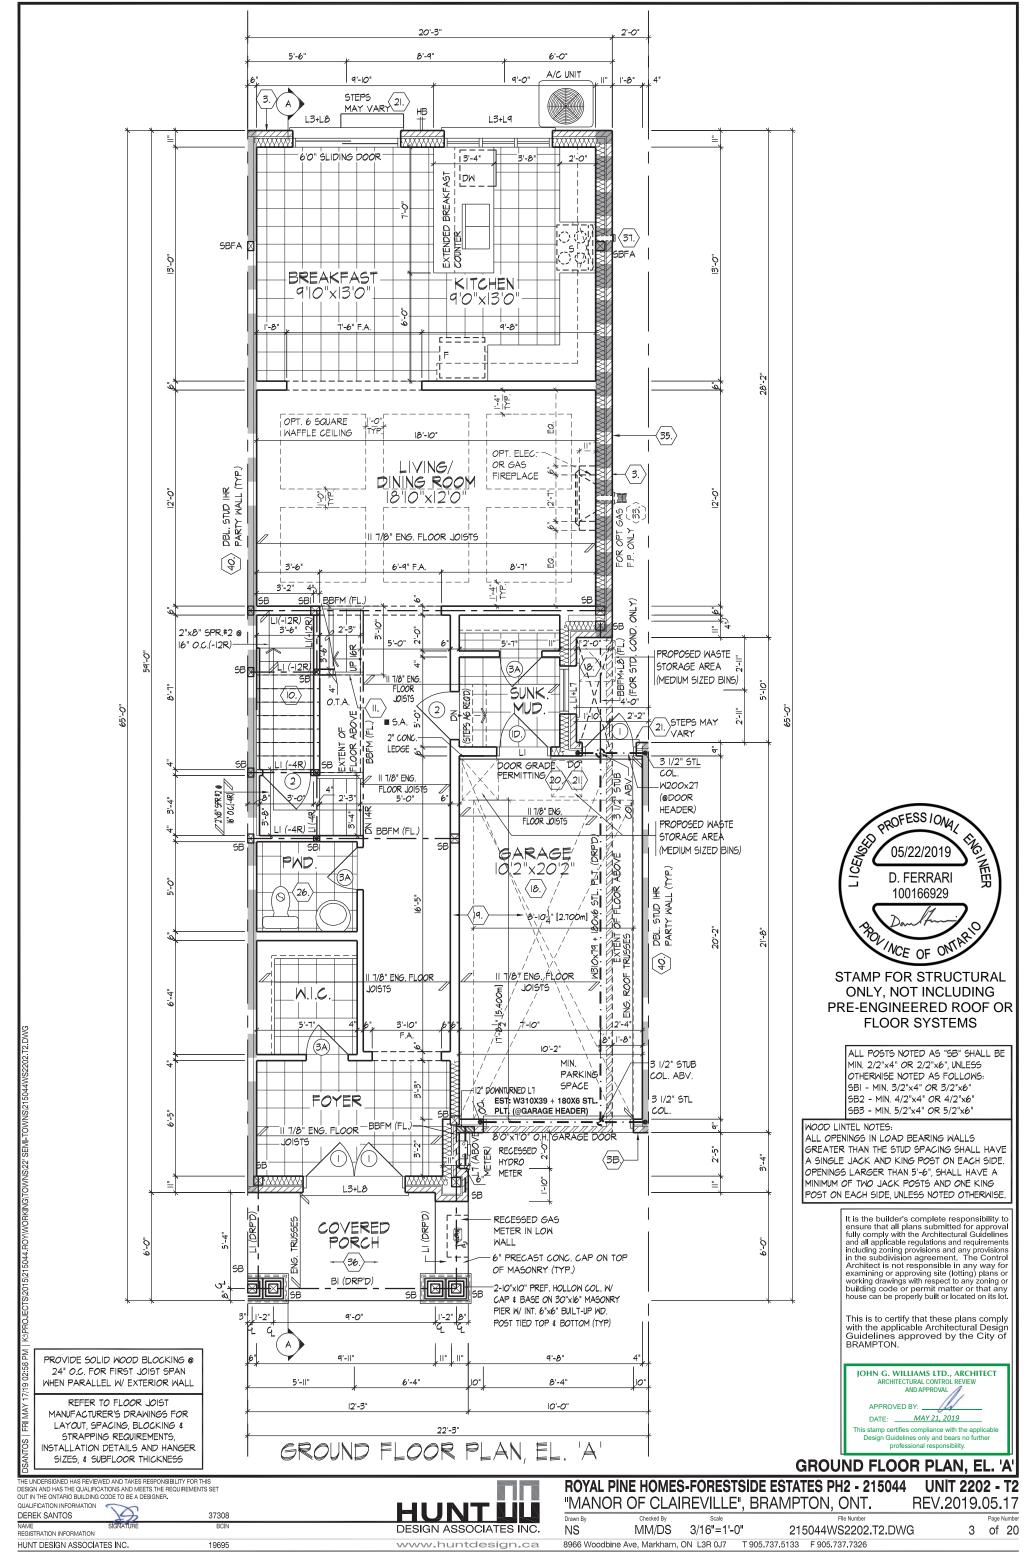

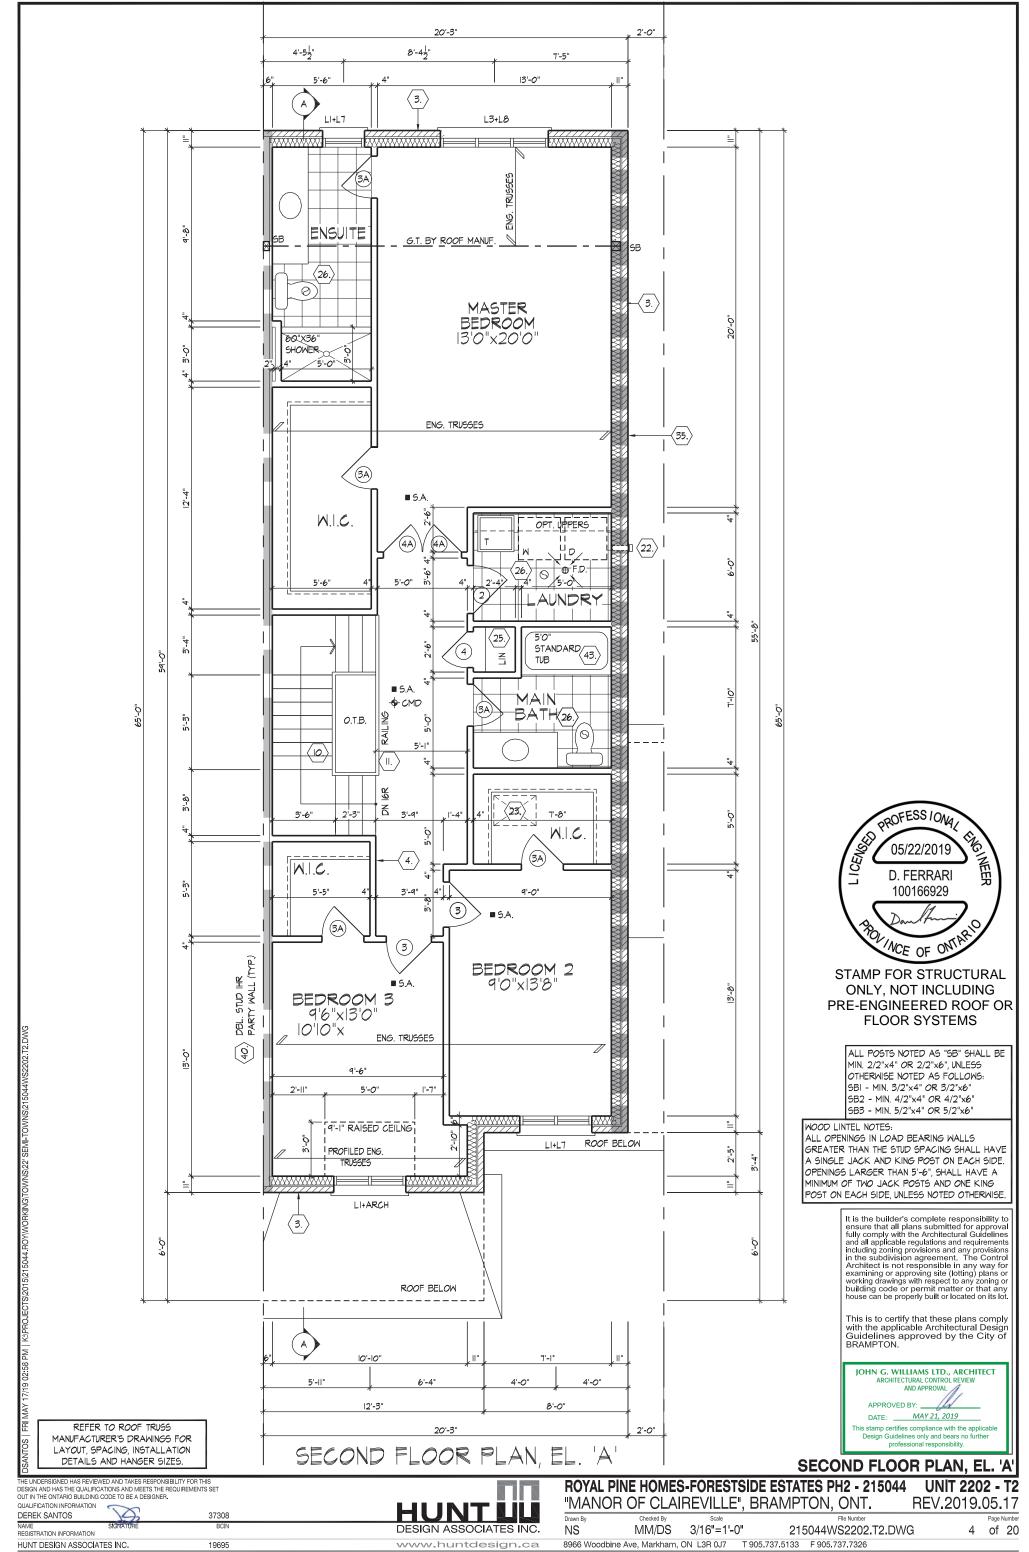


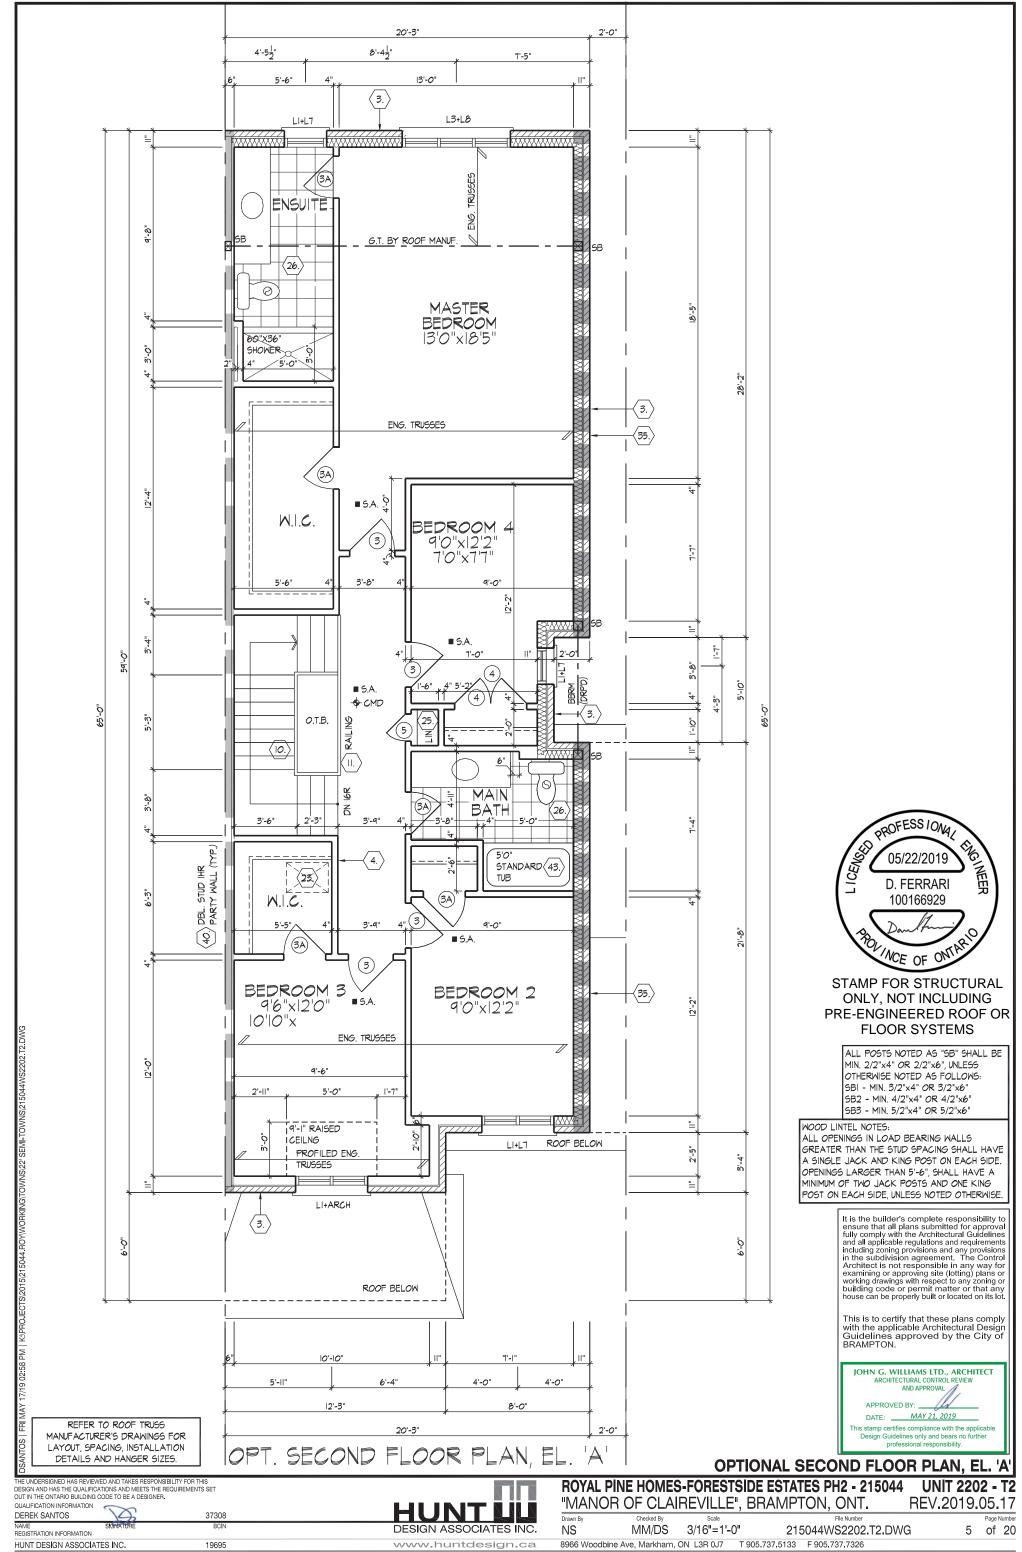


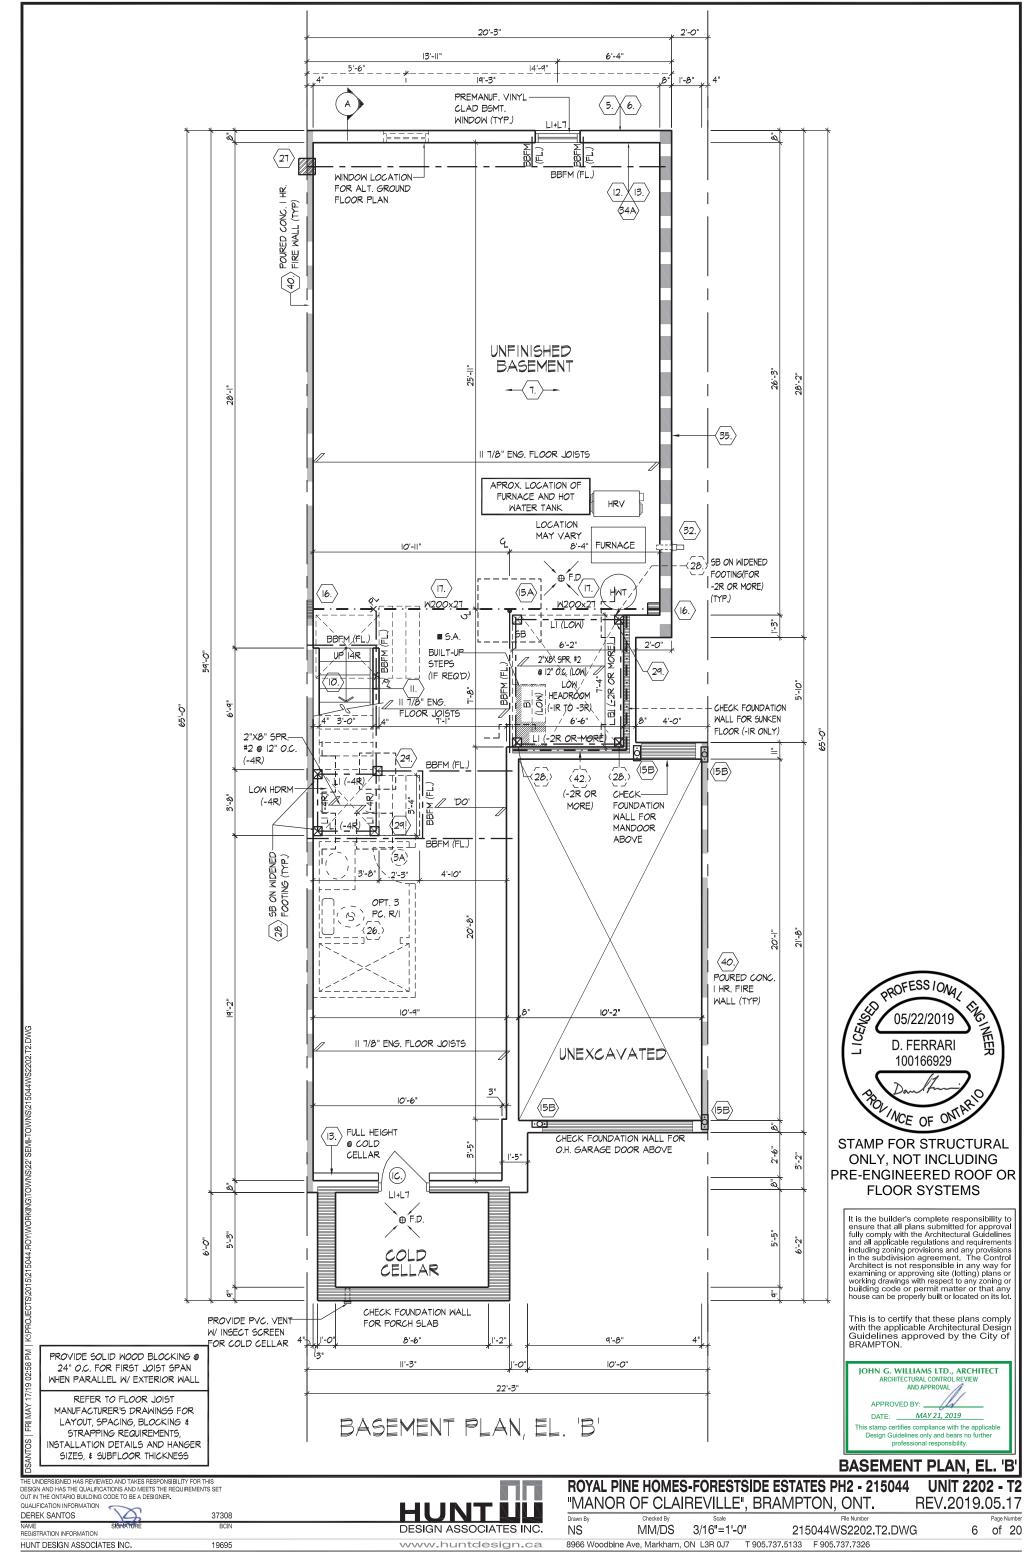

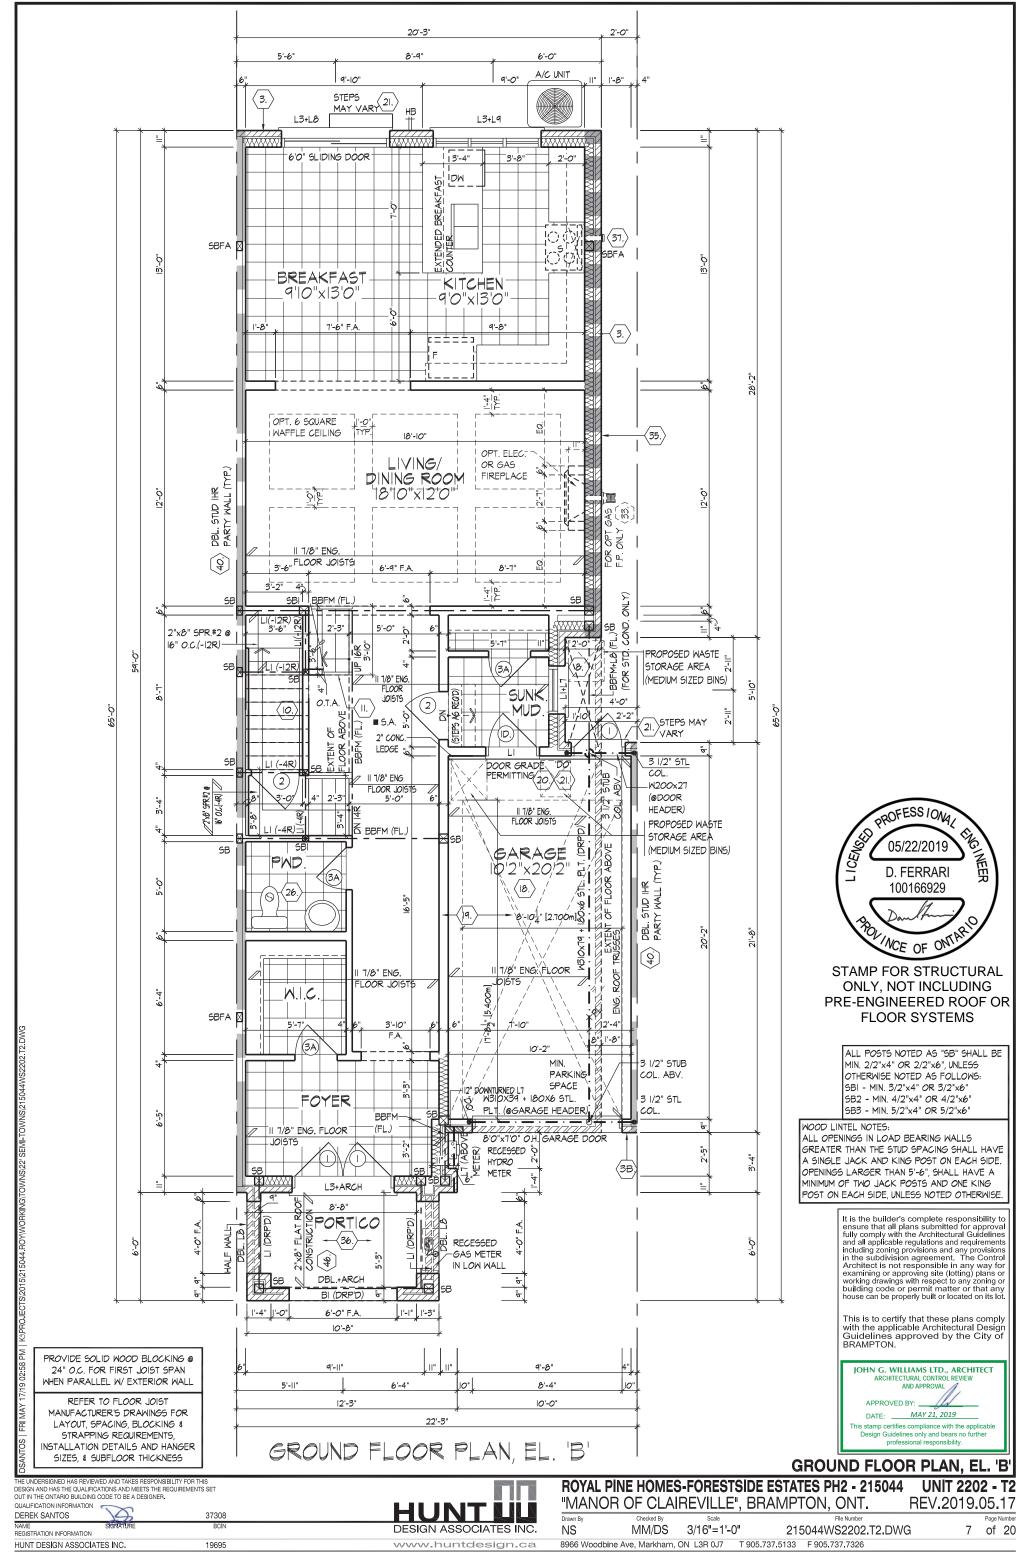



All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature.)

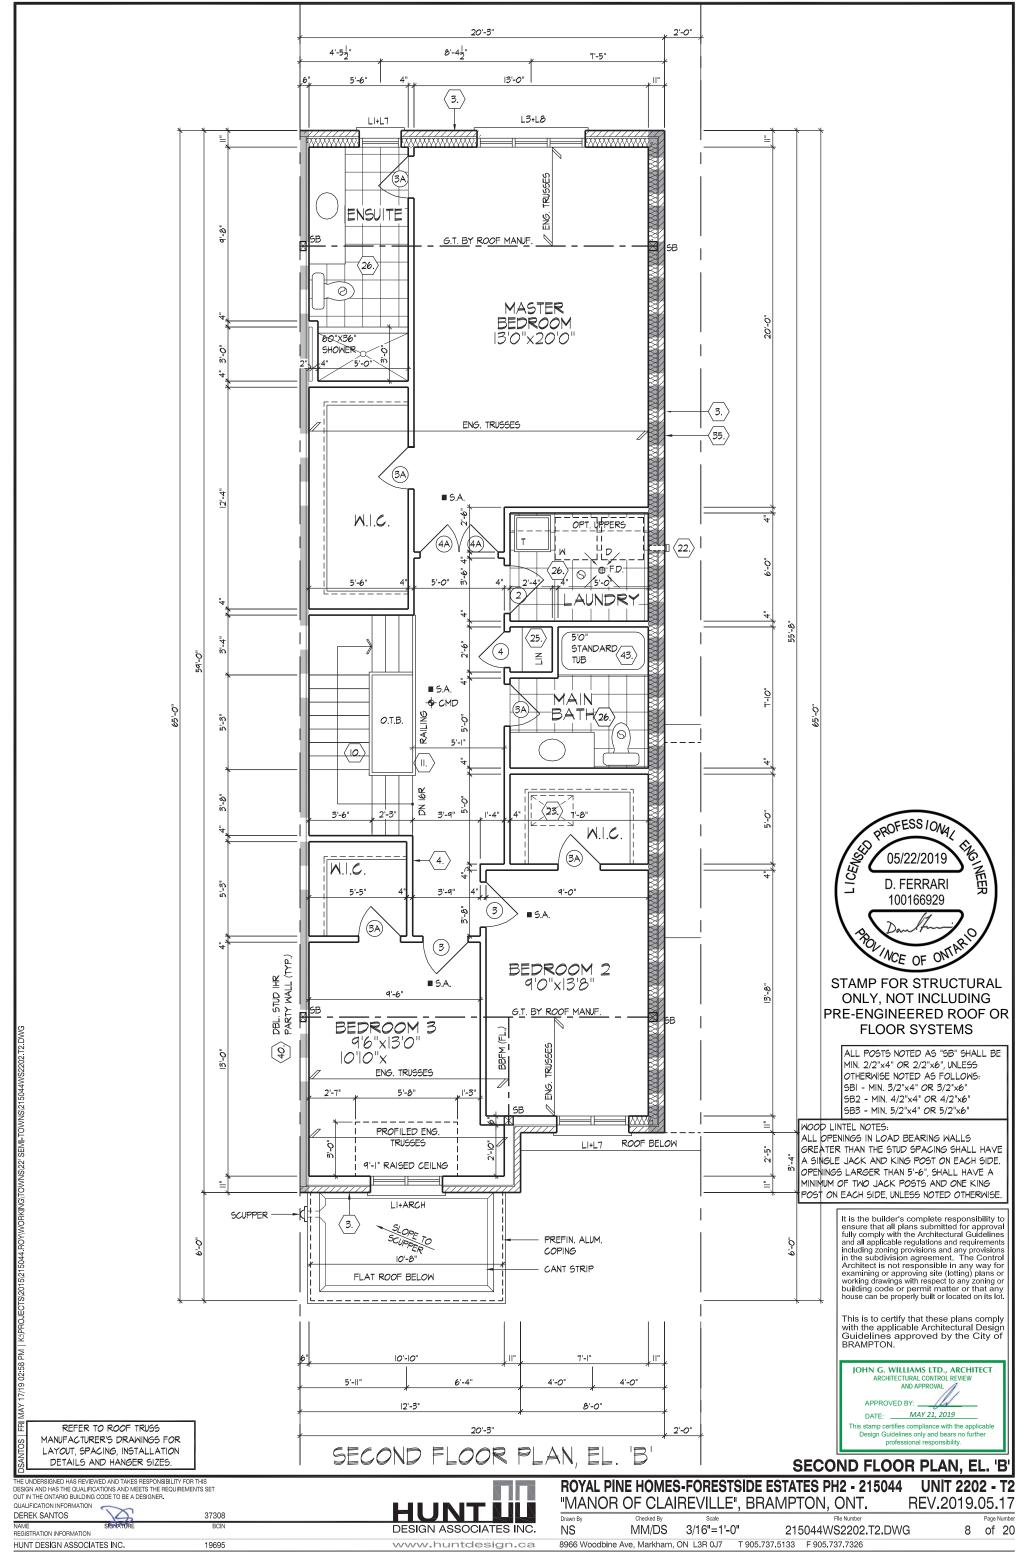


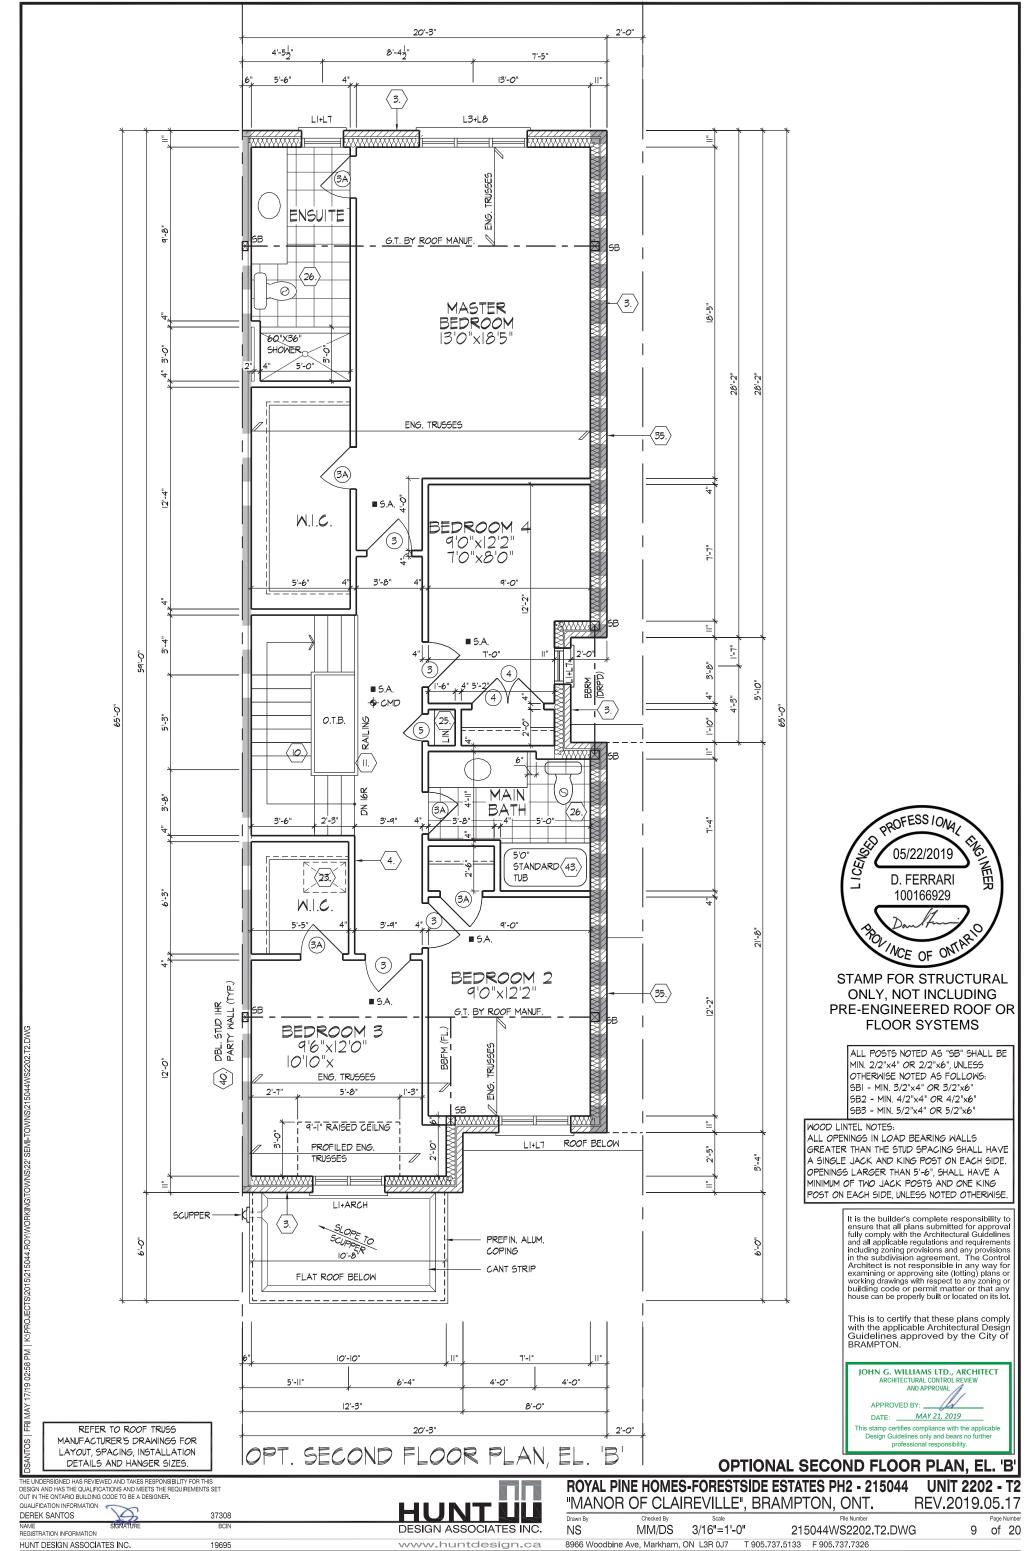



All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BOIN number and original signature.)

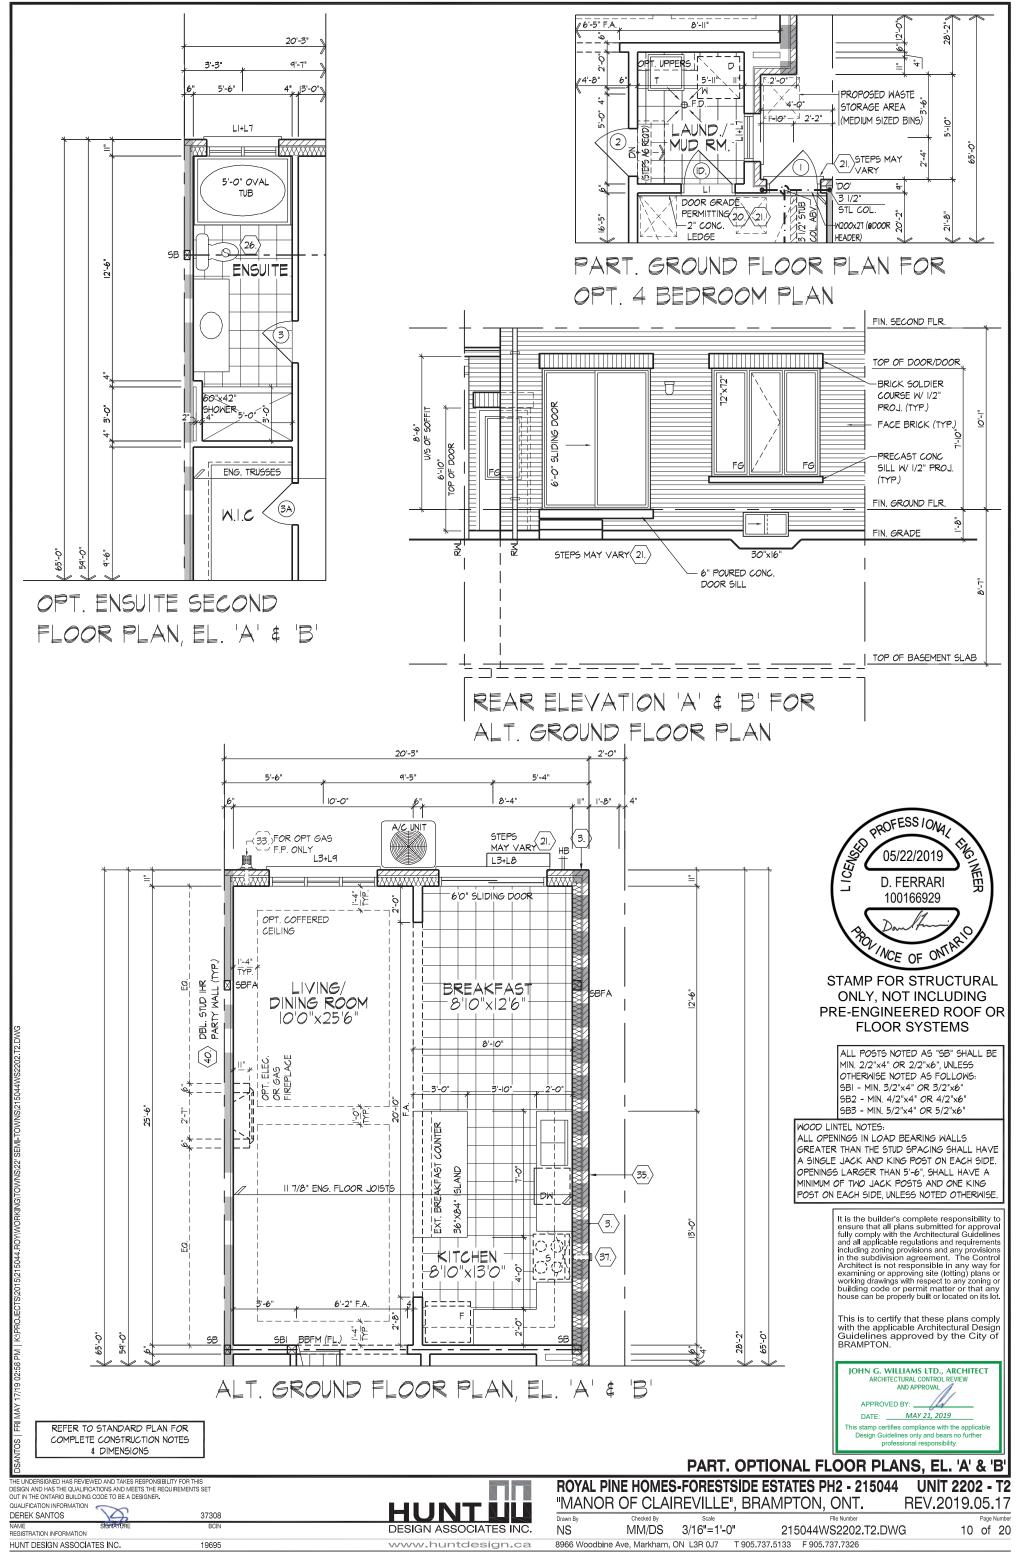


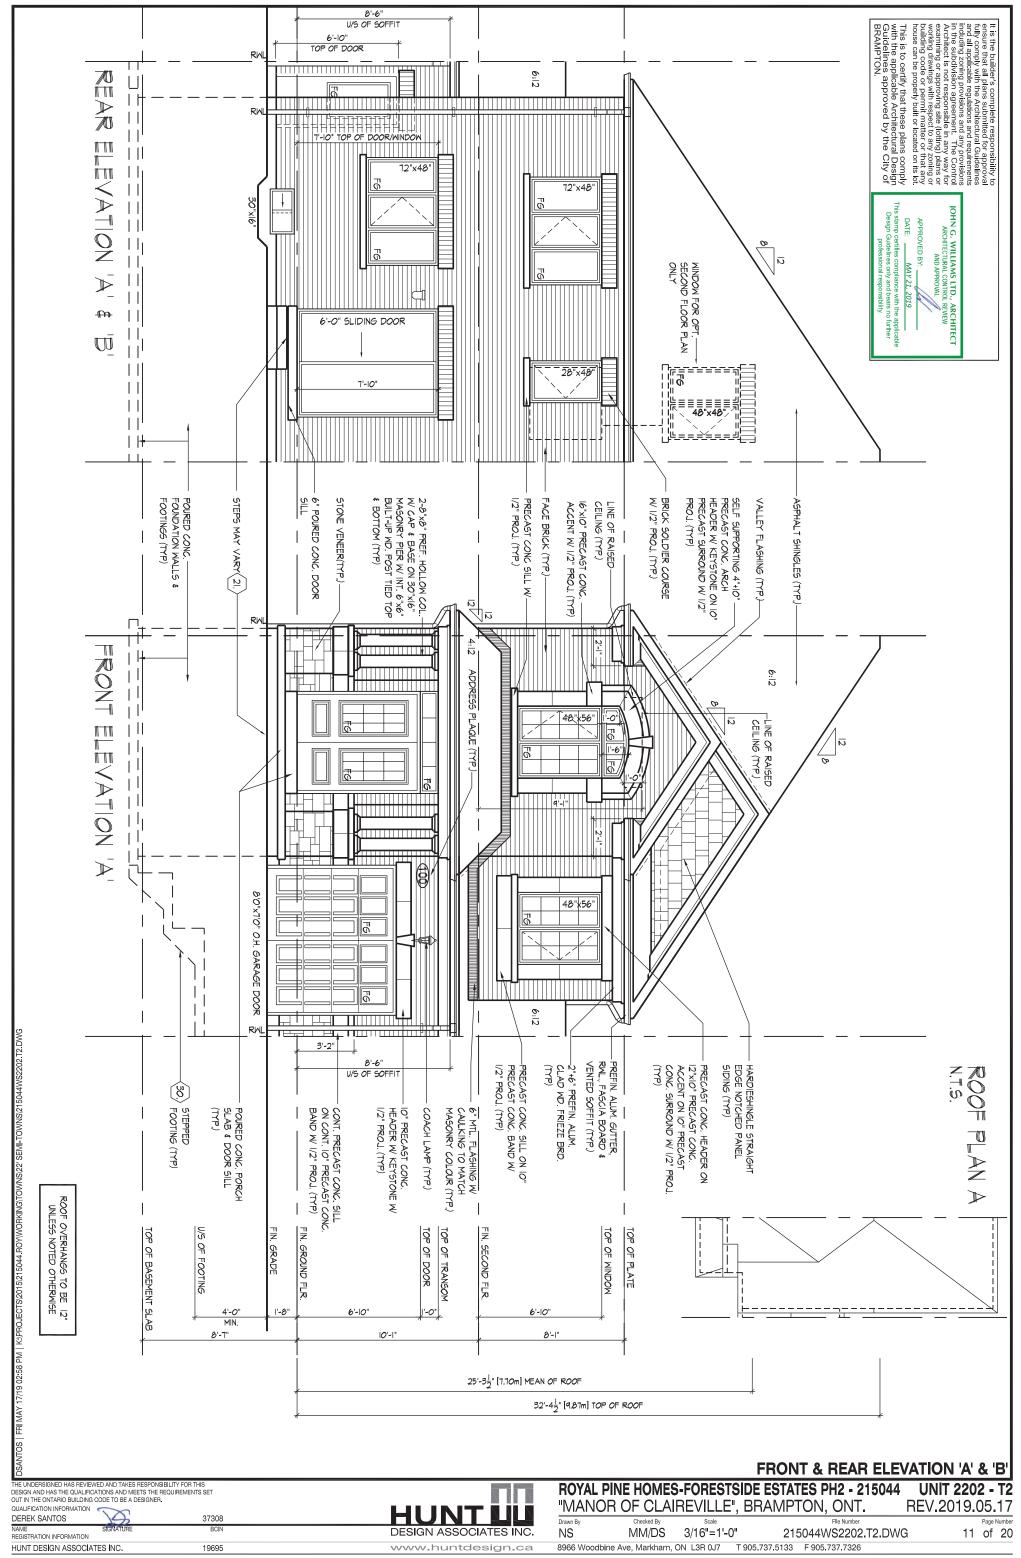


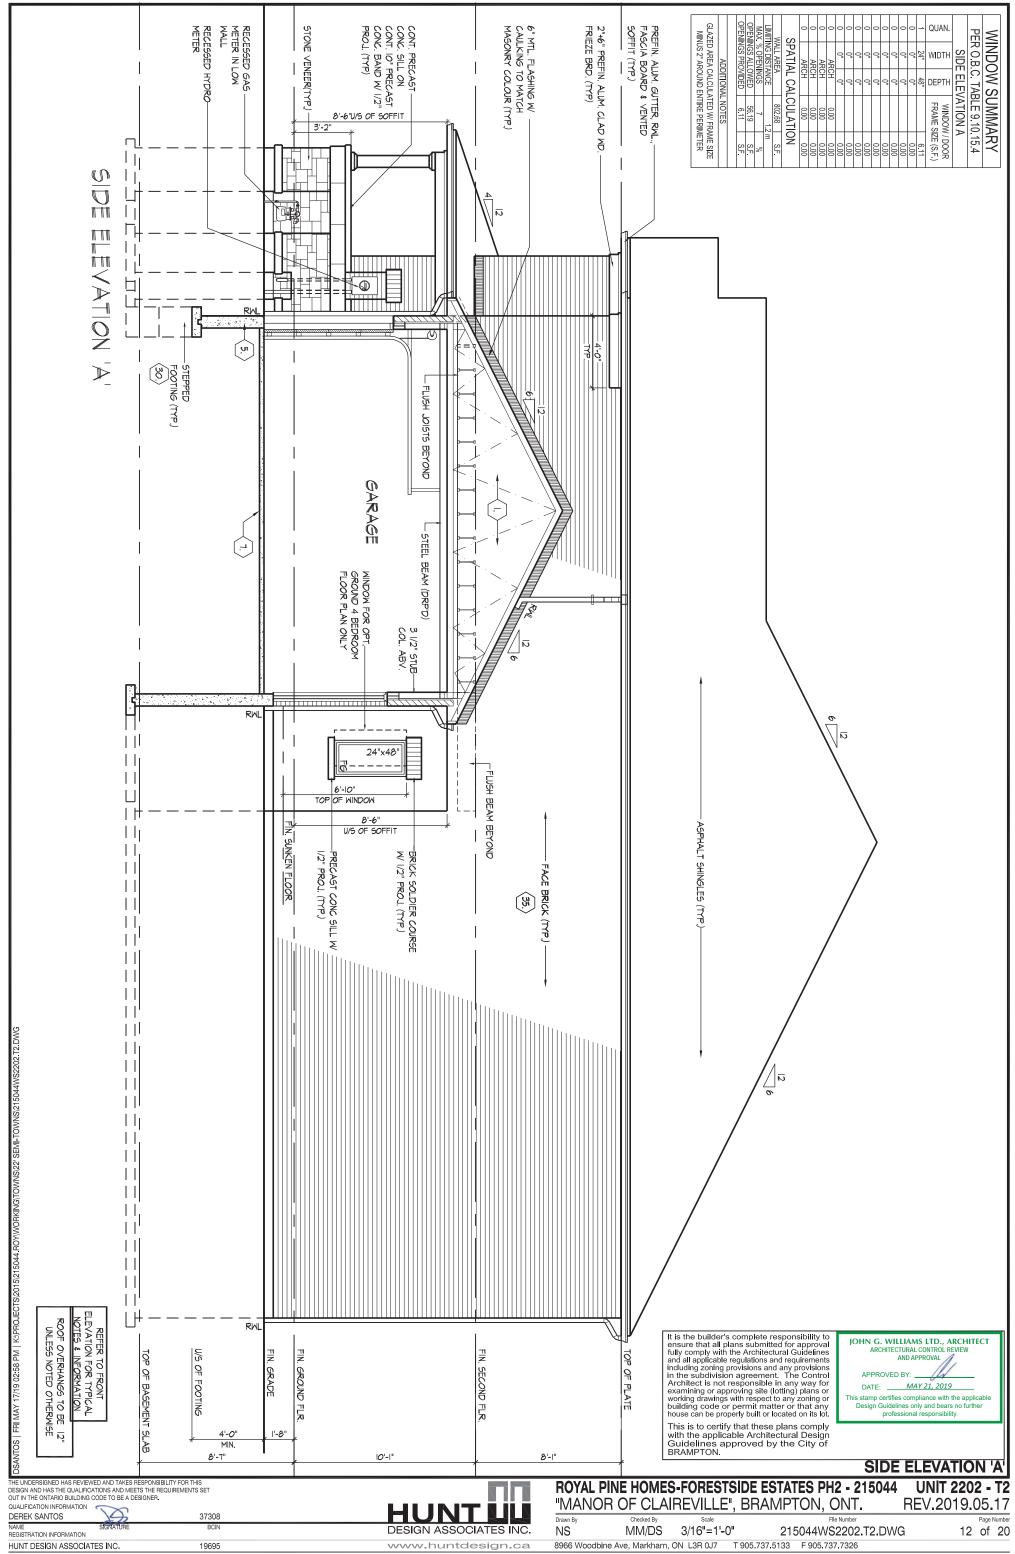


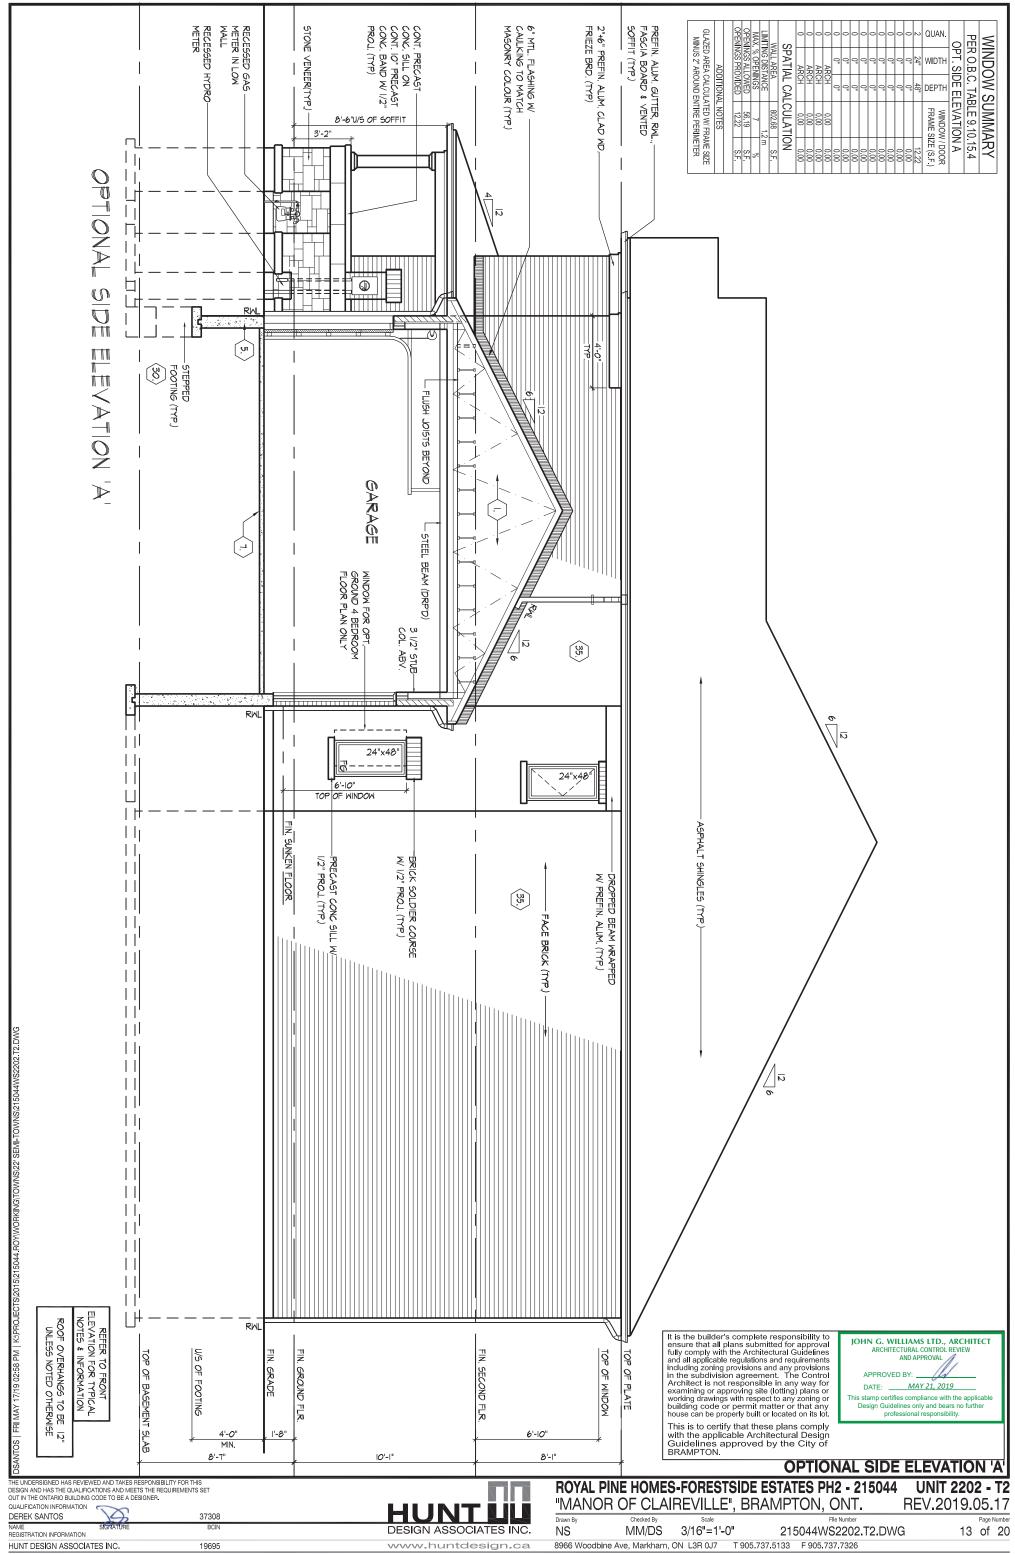

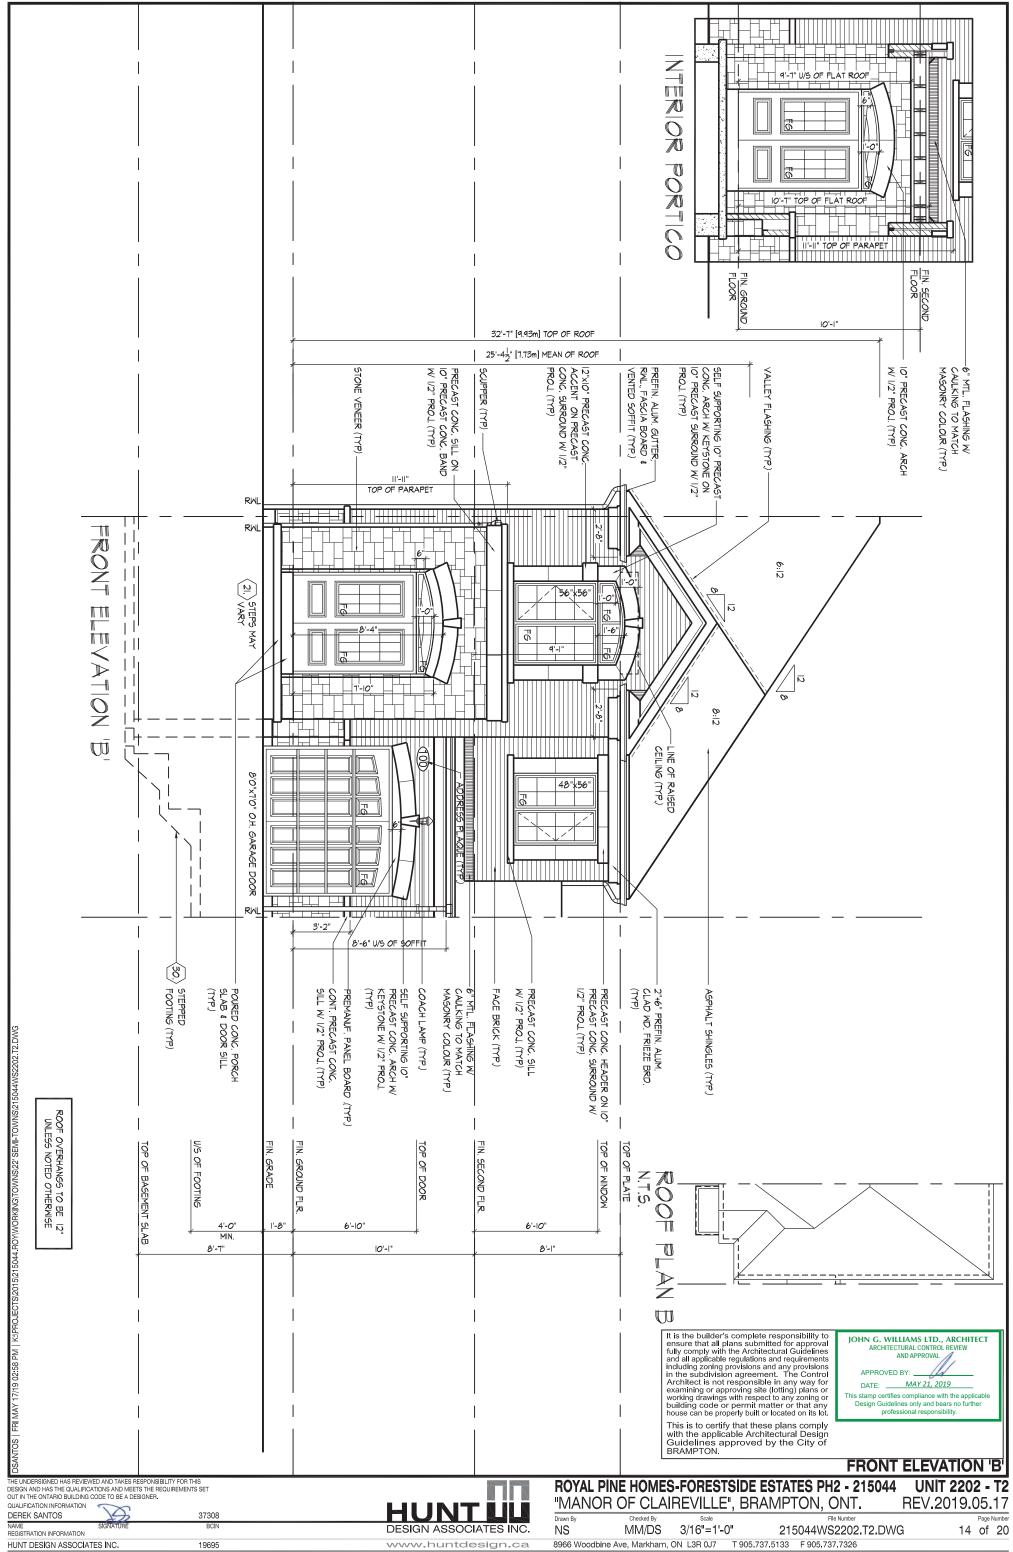


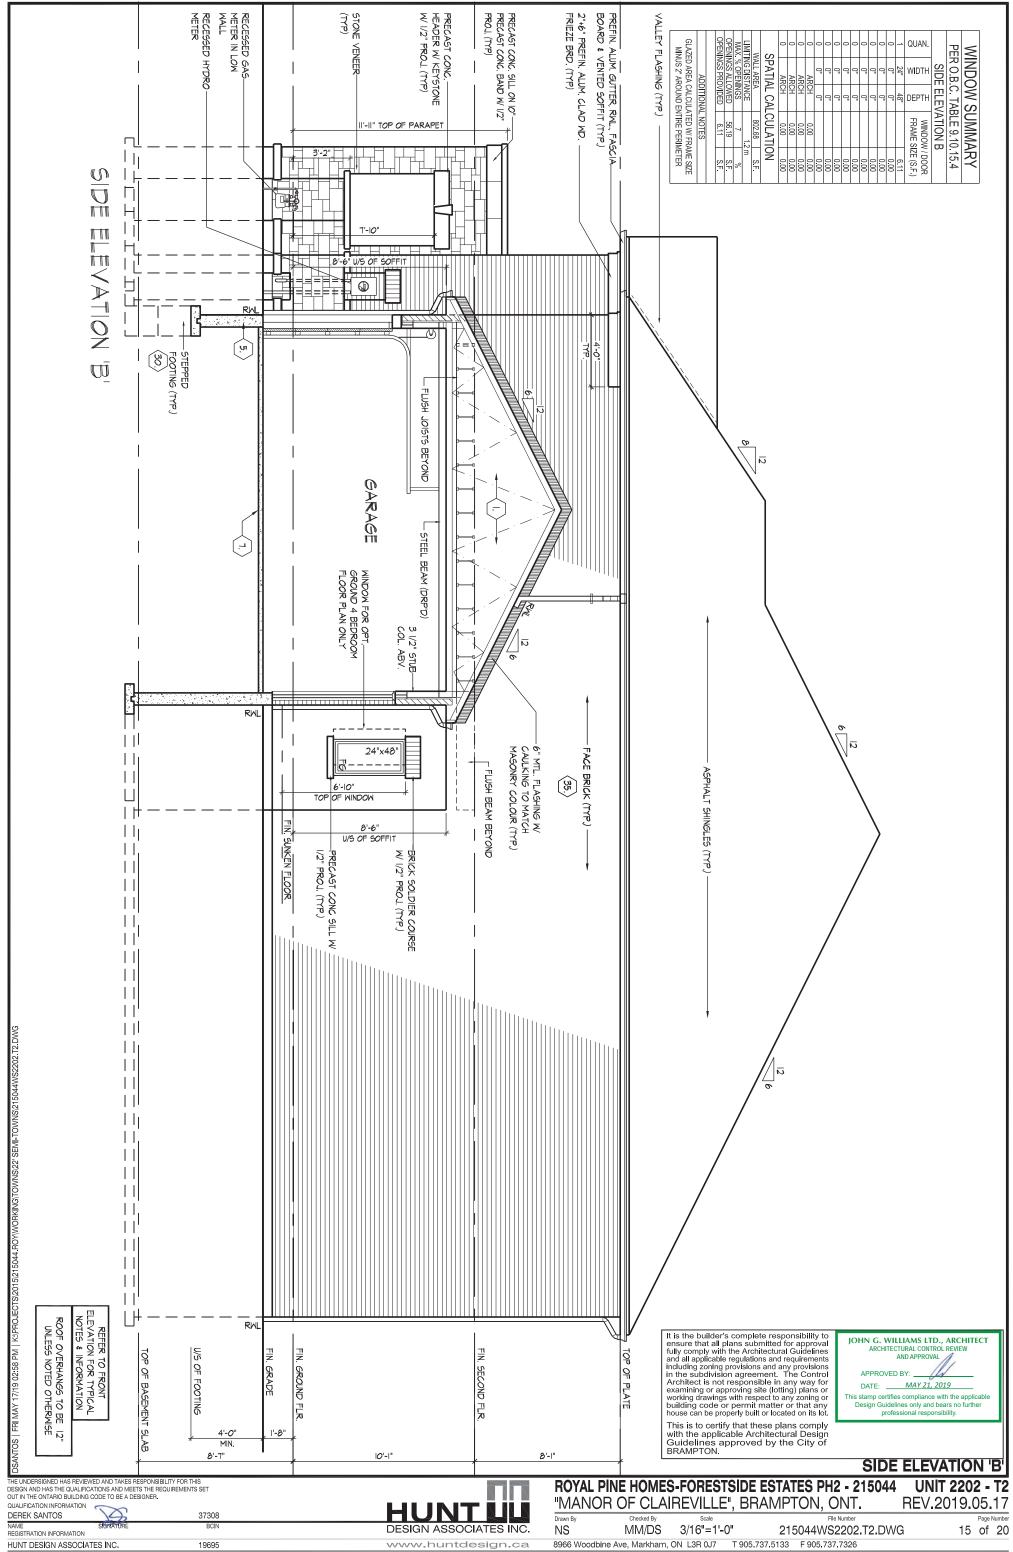

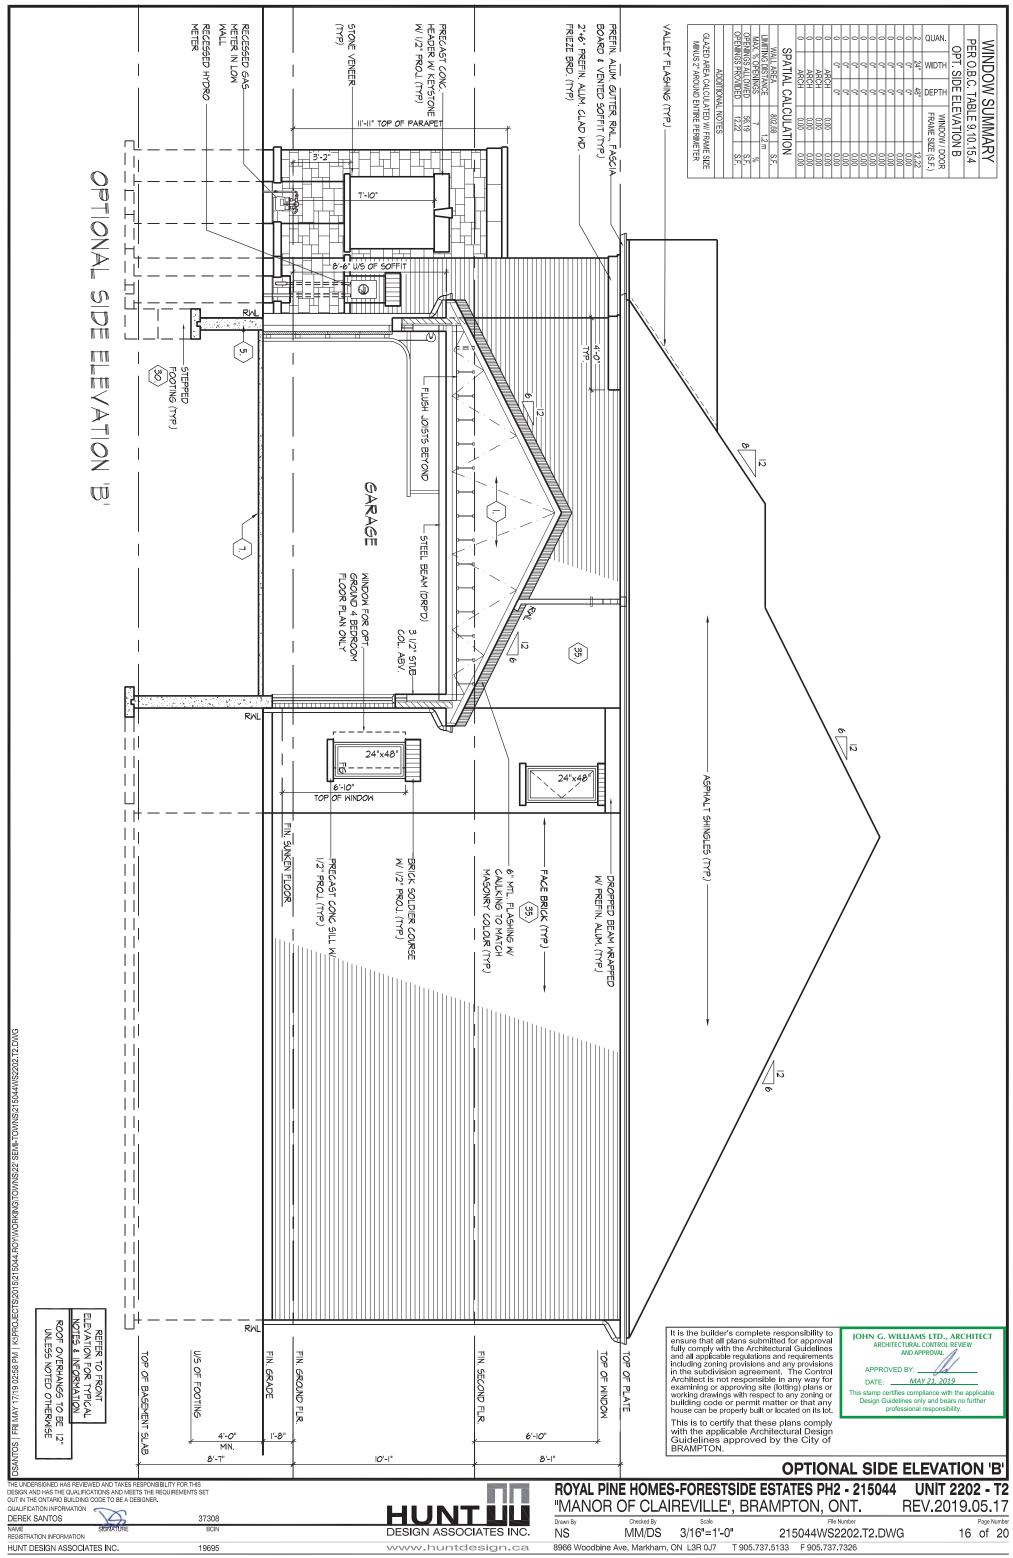


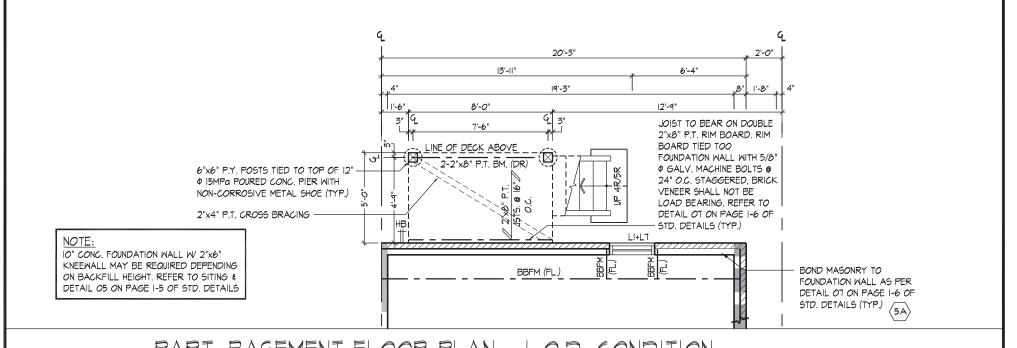

PART. BASEMENT FLOOR PLAN - L.O.D. CONDITION (4/5 RISER DECK CONDITION)

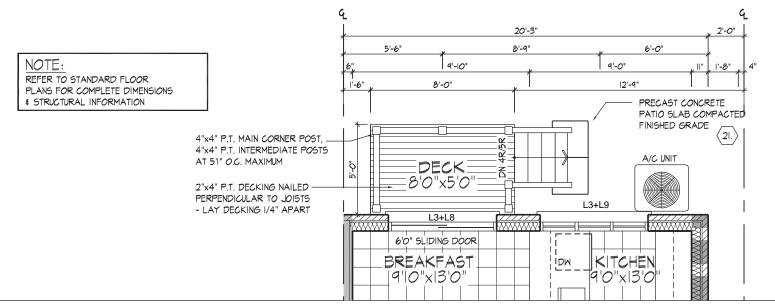

PART. GROUND FLOOR PLAN - L.O.D. CONDITION (4/5 RISER DECK CONDITION)

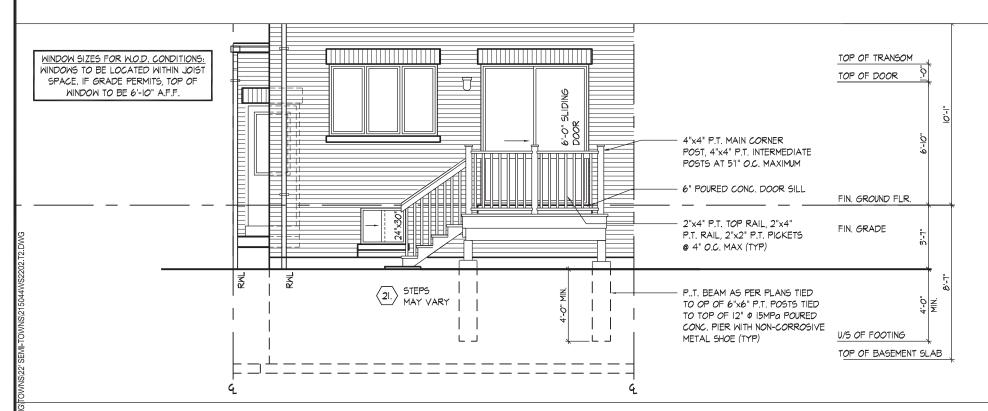

REAR ELEVATION - L.O.D. CONDITION (4/5 RISER DECK CONDITION)



STAMP FOR STRUCTURAL ONLY, NOT INCLUDING PRE-ENGINEERED ROOF OR FLOOR SYSTEMS It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.



LOOK OUT DECK CONDITION

17 of 20

THE UNDERSIGNED HAS RELEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.


37308

OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGN
QUALIFICATION INFORMATION
DEREK SANTOS

HUNT UL
DESIGN ASSOCIATES INC.

ROYAL PINE HOMES-FORESTSIDE ESTATES PH2 - 215044 UNIT 2202 - T2 "MANOR OF CLAIREVILLE", BRAMPTON, ONT. REV.2019.05.17

NS/BB MM/DS 3/16"=1'-0" 215044WS2202.T2.DWG 8966 Woodbine Ave, Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326

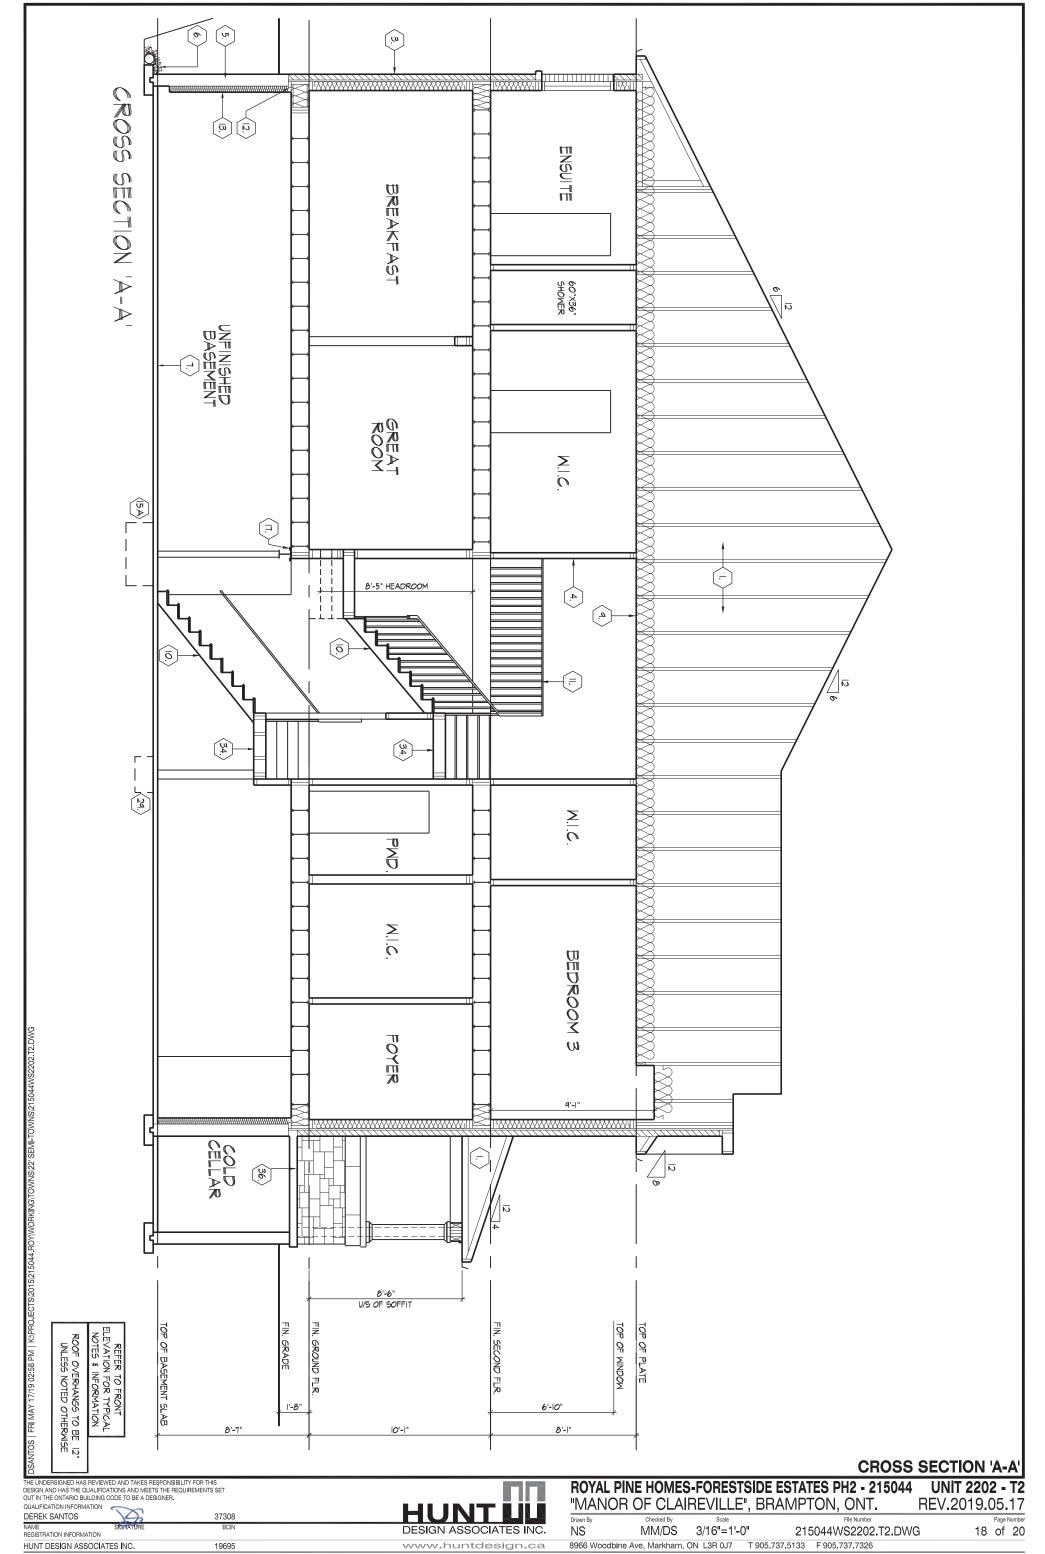

ICE AND WATER SHIELD

PROVIDE ICE AND WATER SHIELD IN THE AREAS INDICATED. THE ICE AND WATER SHIELD SHALL BE A SELF ADHERING AND SELF SEALING MEMBRANE. SIDE LAPS MUST BE A MINIMUM 3 1/2" (90) AND END LAPS A MINIMUM 6" (152). AND TO EXTEND UP DORMER WALLS A MINIMUM 12" (305).

PROFILED ROOF TRUSSES

ROOF TRUSSES SHALL BE PROFILED AND/OR STEPPED AT RAISED COFFER/TRAY CEILINGS. ANGLED TRAY CEILINGS WILL BE SHEATHED W/ 3/8" (9.5) PLYWOOD.

SIDING WALL CONSTRUCTION

SIDING MATERIAL AS PER ELEVATION ATTACHED TO FRAMING MEMBERS FURRING MEMBERS OR BLOCKING BETWEEN THE FRAMING MEMBERS ON APPROVED SHEATHING PAPER ON 3/8" (9.5) EXT. GRADE SHEATHING ON 2'x6" (38x140) STUDS @ 16" (406) O.C., INSULATION, APPROVED 6 MIL POLYETHYLENE AIR/VAPOUR BARRIER, ON 1/2" (12.7) GYPSUM WALLBOARD INT. FIN. (GYPSUM SHEATHING, RIGID INSULATION, AND FIBERBOARD SHALL NOT BE USED FOR THE ATTRIBUTE OF SUMMERS OF SUMERS OF SUMMERS OF SUMMERS OF SUMERS OF SUMMERS OF SUMERS OF SU THE ATTACHMENT OF SIDING (9.23.16.3.(1.)) (REFER TO 35 NOTE AS REQ.)

SIDING WALL CONSTRUCTION W/ CONTIN. INSULATION

SIDING MATERIAL AS PER ELEVATION ATTACHED TO FURRING MEMBERS ON APPROVED AIRWATER BARRIER AS PER O.B.C. 9.27.3. ON EXTERIOR TYPE RIGID INSULATION (JOINTS UNTAPED) MECHANICALLY FASTENED AS PER MANUFACTURERS SPECIFICATIONS ON 3/8" (9.5) EXT. GRADE SHEATHING ON 2"x6" (38x140) STUDS @ 16" (406) O.C., INSULATION, APPROVED 6 MIL POLYETHYLENE AIR/VAPOUR BARRIER, ON 1/2" (12.7) GYPSUM WALLBOARD INT. FIN. (GYPSUM SHEATHING, RIGID INSULATION, AND FIBERBOARD SHALL NOT BE USED FOR THE ATTACHMENT OF SIDING (9.23 1.83 (1.1)) (SPEER TO 3.5 NOTE AS BED.) ATTACHMENT OF SIDING (9.23.16.3.(1.)) (REFER TO 35 NOTE AS REQ.)

SIDING WALL @ GARAGE CONSTRUCTION

SIDING MATERIAL AS PER ELEVATION ATTACHED TO FRAMING MEMBERS, SIDING MATERIAL AS PER ELEVATION ATTACHED TO PRAVING MEMBERS ON PURRING MEMBERS OR BLOCKING BETWEEN THE FRAMING MEMBERS ON APPROVED SHEATHING PAPER ON 3/8" (9.5) EXTERIOR TYPE SHEATHING ON STUDS CONFORMING TO O.B.C (9.23.10.1.) & SECTION 1.1., 1/2" (12.7) GYPSUM WALLBOARD INTERIOR FINISH, (GYPSUM SHEATHING, RIGID INSULATION AND FIBERBOARD SHALL NOT BE USED FOR THE ATTACHMENT OF SIDING (9.23.16.3.(1.)) (REFER TO 35 NOTE AS REQ.)

BRICK VENEER WALL CONSTRUCTION

3 1/2" (90) BRICK VENEER 1" (25) AIR SPACE, 7/8"x7"x0.03" (22x180x0.76) GALV. METAL TIES @ 16" (400) O.C. HORIZ. 24" (600) O.C. VERT. BONDING AND FASTENING FOR TIES TO CONFORM WITH 9.20.9. ON APPROVED SHEATHING PAPER, 38" (9.5) EXTERIOR TYPE SHEATHING, 2"x6" (38x140) STUDS @ 16" (406) O.C., INSULATION AND 6 mil POLYETHYLENE VAPOUR BARRIER WITH APPROVED CONTIN. AIR BARRIER. 1/2" (12.7) GYPSUM WALLBOARD INTERIOR FINISH. PROVIDE WEEP HOLES @ 32" (80.0) O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 6" (150) BEHIND BUILDING PAPER (9.20.13.6.) (REFER TO 35 NOTE AS REQUIRED)

BRICK VENEER WALL CONSTRUCTION W/ CONTIN. INSULATION

3 1/2" (90) BRICK VENEER 1" (25) AIR SPACE , 7/8"x7"x0.03" (22x180x0.76) GALV, METAL TIES @ 16" (400) O.C. HORIZ. 24" (600) O.C. VERT. BONDING AND FASTENING FOR TIES TO CONFORM WITH 9:20.9. ON APPROVED AIRWATER BARRIER AS PER O.B.C. 9.27.3. ON EXTERIOR TYPE RIGID INSULATION (JOINTS UNTAPED) MECHANICALLY FASTENED AS PER MANUFACTURER'S SPECIFICATIONS, ON 3/8" (9.5) EXTERIOR TYPE SHEATHING, 2"x6" (38x 40) STUDS @ 16" (406) O.C., INSULATION AND 6 mil POLYETHYLENE VAPOUR BARRIER WITH APPROVED CONTIN. AIR BARRIER. 1/2" (12.7) GYPSUM WALLBOARD INTERIOR FINISH. PROVIDE WEEP HOLES @ 32" (800) O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 6" (150) OVER RIGID INSULATION (9.20.13.6.) (REFER TO 35 NOTE AS REQUIRED)

BRICK VENEER WALL @ GARAGE CONSTRUCTION

3 1/2" (90) BRICK VENEER, MIN. 1" (25) AIR SPACE, 7/8"x7"x0.03" (22x180x0.76) GALV. METAL TIES @ 16" (400) O.C. HORIZ. 24" (600) O.C. VERT. BONDING AND FASTENING FOR TIES TO CONFORM WITH 9.20.9. ON APPROVED SHEATHING PAPER, 3/8" (9.5) EXTERIOR TYPE SHEATHING ON STUDS CONFORMING TO O.B.C (9.23.10.1.) & SECTION 1.1., 1/2" (12.7) GYPSUM WALLBOARD INTERIOR FINISH, PROVIDE WEEP HOLES @ 32" (800) O.C. AT BOTTOM COURSE AND OVER OPENINGS, PROVIDE BASE FLASHING UP 6" (150) MIN. BEHIND BUILDING PAPER (9.20.13.6.) (REFER TO 35 NOTE AS REQ.)

INTERIOR STUD PARTITIONS (9.23.9.8., 9.23.10)

BEARING PARTITIONS SHALL BE A MINIMUM 2"x4" (38x89) @ 16" (406) O.C. FOR 2 BEARING PARTITIONS STALL BE A MINIMON 2'X4" (38X89) @ 16" (406) O.C. FOR 2 STOREY AND 12" (305) O.C. FOR 3 STOREY, NON-BEARING PARTITIONS 2"X4" (38X89) @ 24" (610) O.C. PROVIDE 2"X4" (38X89) BOTTOM PLATE AND 2-2"X4" (2-38X89) TOP PLATE. 1/2" (12.7) INT. DRYWALL BOTH SIDES OF STUDS, PROVIDE 2"X6" (38X140) STUDS WHERE NOTED. PROVIDE 2"X4" (38X89) @ 24" (610) O.C. LADDER FRAMING WHERE WALLS INTERSECT PERPENDICULAR TO ONE ANOTHER. PROVIDE 2"X4" (29x80) WOOD BLOOKING ONE 1.0" (2) 14" (140.4) O.C. MAY RETWING THE LEGORE (200.4) (200.4 38x89) WOOD BLOCKING ON FLAT @ 3'-11" (1194) O.C. MAX. BETWEEN FLOOR JOISTS WHEN NON-LOADBEARING WALLS ARE PARALLEL TO FLOOR JOISTS.

EXT. LOFT WALL CONSTRUCTION - NO CLADDING

3/8" (9.5) EXTERIOR TYPE SHEATHING, 2"x6" (38x140) STUDS @ 16" (406) O.C INSULATION AND 6 mil POLYETHYLENE VAPOUR BARRIER WITH APPROVED CONT. AIR BARRIER. 1/2" (12.7) GYPSUM WALLBOARD INT. FINISH. (9.23.)

EXT. LOFT WALL CONSTRUCTION - NO CLADDING W/ CONTINUOUS INSULATION

APPROVED AIR.WATER BARRIER AS PER O.B.C. 9.27.3. ON EXTERIOR TYPE RIGID INSULATION (JOINTS UNTAPED) MECHANICALLY FASTENED AS PER MANUFACTURER'S SPECIFICATIONS, ON 3/8" (9.5) EXTERIOR TYPE SHEATHING, 2"x6" (38x140) STUDS @ 16" (406) O.C. INSULATION AND 6 mil POLYETHYLENE VAPOUR BARRIER WITH APPROVED CONT. AIR BARRIER. 1/2" (12.7) GYPSUM WALLBOARD INT. FINISH. (9.23.)

FOUNDATION WALL/FOOTINGS

POURED CONC. FOUNDATION WALL AS PER CHART BELOW ON CONTINUOUS KEYED CONCRETE FOOTING. THE OUTSIDE OF THE FOUNDATION SHALL BE DAMPROOFED FROM THE TOP OF THE FOOTING TO FINISHED GRADE AND BRUSH COAT FROM THE TOP TO? BELOW GRADE. PROVIDE A DRAINAGE LAY ON THE OUTSIDE OF THE FOUNDATION WALL. SEAL THE DRAINAGE LAYER AT THE TOP. THE TOP OF THE CONC. FOOTING SHALL BE DAMPROOFED.

CONCRETE FOOTINGS SUPPORTING JOIST SPANS GREATER THAN 16'-1" (4900) SHALL BE SIZED IN ACCORDANCE WITH 9.15.3.4 (1),(2) OF THE O.B.C. (REFER TO CHART BELOW FOR RESPECTIVE SIZE). BRACE FOUNDATION WALL PRIOR TO BACKFILLING. ALL FOOTINGS SHALL REST ON NATURAL UNDISTURBED SOIL OF 75KPa OR COMPACTED ENGINEERED FILL WITH MIN. BEARING CAPACITY OF 150KPa. IF SOIL BEARING DOES NOT MEET MINIMUM CAPACITY, ENGINEERED FOOTINGS ARE REQUIRED. ACTUAL SOIL BEARING CAPACITY TO BE VERIFIED WITH SOIL ENGINEERING REPORT.

REFER TO CONSTRUCTION DRAWINGS AND DETAILS FOR FOUNDATION WALL STRENGTH AND THICKNESS AND 9.15.4.

FOUNDATION WALLS SHALL NOT EXCEED 9-10" (3.0m) IN UNSUPPORTED HEIGHT UNLESS OTHERWISE NOTED. [9.15.4.2.(1.)]

| | UNREINFORCED SOLID CONCRETE FOUNDATION WALLS (9.15.4.2.) | | | | | | | |
|----------|--|----------------|---------------|--------------------------|----------------|--|--|--|
| 픑 | ESS | MAX | . HEIGHT FROM | F I N. SLAB TO GR | ADE | | | |
| STRENGTH | THICKNESS | UNSUPPORTED | SI | JPPORTED AT TO |)P | | | |
| ST | 三 | AT TOP | ≤2.5m | >2.5m & ≤2.75m | | | | |
| g | * 8" | 3'-11" (1.20m) | 7'-0" (2.15m) | 7'-0" (2.15m) | 6'-10" (2.10m) | | | |
| ₽ | 10" | 4'-7" (1.40m) | 7'-6" (2.30m) | 8'-6" (2.60m) | 8'-2" (2.50m) | | | |
| 15 | 12" | 4'-11" (1.50m) | 7'-6" (2.30m) | 8'-6" (2.60m) | 9'-3" (2.85m) | | | |
| МРа | * 8" | 3'-11" (1.20m) | 7'-6" (2.30m) | 7'-6" (2.30m) | 7'-2" (2.20m) | | | |
| | 10" | 4'-7" (1.40m) | 7'-6" (2.30m) | 8'-6" (2.60m) | 9'-3" (2.85m) | | | |
| 20 | 12" | 4'-11" (1.50m) | 7'-6" (2.30m) | 8'-6" (2.60m) | 9'-3" (2.85m) | | | |

* 9" MIN. THICK FOUNDATION WALL IS REQUIRED FOR MASONRY VENEER FINISHED EXTERIOR WALLS WITH CONTINUOUS INSULATION CONDITION, TO PROVIDE MIN. BEARING FOR SILL PLATES, BEAMS AND FLOOR JOIST AS PER 9.23.7.2., 9.23.8.1., & 9.23.9.1. OF THE O.B.C.

| MINIMUM STRIP FOOTING SIZES (9.15.3.) | | | | | | |
|---------------------------------------|--|------------------------|-------------------------|--|--|--|
| NUMBER FLOORS SUPPORTED | SUPPORTING INT. LOAD BEARING MASONRY WALLS | SUPPORTING EXTERIOR | SUPPORTING PARTYWALL | | | |
| 1 | 16" WIDE x 6" THICK | 16' WIDE x 6" THICK | 16" WIDE x 6" THICK | | | |
| 2 | 24" WIDE x 8" THICK | 20' WIDE x 6" THICK | 24" WIDE x 8" THICK | | | |
| 3 | 36" WIDE x 14" THICK | 26' WIDE x 9" THICK | 36" WIDE x 14" THICK | | | |

REFER TO SB-12 ENERGY EFFICIENCY DESIGN MATRIX ON THE TITLE PAGE FOR ALL VALUES AS REQUIRED PER 3.1.1., 3.1.2., 3.1.3. OF THE OBC.

FOUNDATION REDUCTION IN THICKNESS FOR MASONRY WHERE THE TOP OF THE FOUNDATION WALL IS REDUCED IN THICKNESS TO WHERE THE 107 OF THE POUNDATION WALL IS REDUCED IN TIGICATESS TO PERMIT THE INSTALLATION OF MASONRY EXTERIOR FACING, THE REDUCED SECTION SHALL BE NOT LESS THAN 3 1/2" (90) THICK. THE BRICK VENEER SHALL BE TIED TO THE FOUNDATION WALL WITH CORROSION RESISTANT METAL TIES (9 7 7/8" (200) VERTICAL AND 2-11" (889) HORIZONTAL FILL VOID WITH MORTAR BETWEEN WALL AND BRICK VENEER (9.15.4.7(2)(3) & 9.20.9.4(3))

FOUNDATION REDUCTION IN THICKNESS FOR JOISTS WHERE THE TOP OF THE FOUNDATION WALL IS REDUCED IN THICKNESS TO PERMIT THE INSTALLATION OF FLOOR JOISTS. THE REDUCED SECTION SHALL BE NOT MORE THAN 13 3/4" (350) HIGH & NOT LESS THAN 3 1/2" (90) THICK (9.15.4.7(1))

4" (100) Ø WEEPING TILE W/ FILTER CLOTH WRAP & 6" (152) CRUSHED STONE COVER

BASEMENT SLAB OR SLAB ON GRADE (9.16.4.3.) 3" (80) MIN, 25MPa (3600psi) CONC, SLAB ON 4" (100) COARSE GRANULAR FILL OR 20MPa (2900psi) CONC. WITH DAMPPROOFING BELOW SLAB. PROVIDE 1/2" (12.7) IMPERVIOUS BOARD FOR BOND BREAK AT EDGE. (9.13.) WHERE A

BASÉMENT SLAB IS WITHIN 24" (610) OF THE EXTERIOR GRADÉ PROVIDE RIGID INSUL. AROUND THE PERIMETER EXTENDING MIN. 24" (610) BELOW GRADE. FOR SLAB ON GRADE CONDITIONS RIGID INSULATION SHALL BE APPLIED TO THE UNDERSIDE OF THE ENTIRE SLAB. ([SB-12] 3.1.1.7.(5) & (6))

EXPOSED FLOOR TO EXTERIOR

PROVIDE SPRAY FOAM INSULATION BETWEEN CANT. JOIST AND INSTALL FIN. SOFFIT OR CLADDING AS PER ELEVATION TO U/S OF EXPOSED CANT. JOIST.

EXPOSED CEILING TO EXTERIOR W/ ATTIC

INSULATION, 6 mil POLYETHYLENE VAPOUR BARRIER, 1/2" (12.7) GYPSUM BOARD INTERIOR FINISH OR APPROVED FO

EXPOSED CEILING TO EXTERIOR W/o ATTIC

JOISTS/TRUSSES AS PER PLANS W/ 2"x2" (38x38) PURLINS @ 16" (406) O.C. PERPENDICULAR TO JOISTS (PURLINS NOT REQ. W/ SPRAY FOAM OR ROOF TRUSSES), W/ INSULATION BETWEEN JOIST, 6 mil POLYETHYLENE VAPOUR BARRIER, 1/2" (12.7) GYPSUM BOARD INT. FINISH OR APPROVED EQ. (CAN/ULC-S705.2, 9.19.1)

<u>ALL STAIRS/EXTERIOR STAIRS</u> (9.8.1.2., 9.8.2., 9.8.4.)

| | | MAX. RISE | MIN. F | RISE | MAX. RUN | MIN. RUN | MAX. TREAD | Mi | V. TREAD |
|-----|----------------------|-------------|-----------|------|------------|----------------------|------------|------|------------|
| | PRIVATE 7 7/8" (200) | | 5" (12 | 25) | 14' (355) | 8 1/4" (210) | 14" (355) | 9 1 | 1/4' (235) |
| | PUBLIC | 7" (180) | 5" (12 | 25) | NO LIMIT | 11' (280) | NO LIMIT | 1 | 1" (280) |
| Γ | | A UNI OTAID | AIR WIDTH | | OLIDVED OT | AIDO | ALL O | TAID | 0 |
| - 1 | | MIN. STAIR | WIDIH | | CURVED ST | AIRS | ALL S | IAIK | S |
| ł | PRIVATE | | | | | 5 7/8 ' (150) | MAX. NOSIN | | 1' (25) |

WIDTH OF STAIRS FROM A STRAIGHT LINE TO THE TREAD & LANDING NOSING TO LOWEST POINT ABOVE AND NOT LESS THAN 6-5" (1950) FOR SINGLE DWELLING UNIT & 6'-8 3/4" (2050) FOR EVERYTHING ELSE. (9.8.2.2.) REQUIRED LANDING IN GARAGE - O.B.C. 9.8.6.2.(3.)

FOR AN EXTERIOR STAIR SERVING A GARAGE, W/ MORE THAN 3 RISERS GUARDS, HANDRAILS & STEPS AS PER CONSTRUCTION HEX NOTE 10 & 11.

GUARDS/RAILINGS (9.8.7., 9.8.8.)

GUARDS TO BE DESIGNED NOT TO FACILITATE CLIMBING AND PROVIDING MAX. OPENING CONFORMING TO O.B.C. 9.8.8.5. & 9.8.8.6. AND BE ABLE TO RESIST LOADS AS PER TABLE 9 8 8 2

GUARD HEIGHTS - O.B.C. 9.8.8.

INTERIOR GUARDS: 2'-11" (900) MIN.

EXTERIOR GUARDS: 2'-11" (900) MIN. (LESS THAN 5'-11" (1800) TO GRADE)
3-6' (1070) MIN. (MORE THAN 5'-11" (1800) TO GRADE)
GUARDS FOR EXIT STAIRS: 3'-0' (920) MIN.
GUARDS FOR LANDINGS @ EXIT STAIRS: 3'-6" (1070) MIN.

GUARDS FOR FLOORS & RAMPS IN GARAGES (SERVICE STAIRS) FLOOR OR RAMP W/O EXTERIOR WALLS THAT IS 23 5/8" (600) OR MORE ABOVE ADJACENT SURFACE REQUIRES CONT. CURB MIN. 6" (150) HIGH, AND GUARD

REQUIRED GUARDS BETWEEN WALKING SURFACE & ADJACENT SURFACE WITH A DIFFERENCE IN ELEVATION MORE THAN 23 5/8" (600) OR ADJACENT SURFACE WITHIN 3-11" (1200) & WALKING SURFACE W/ A SLOPE MORE THAN 1 IN 12 SHALL BE PROTECTED WITH GUARDS PER CONSTRUCTION HEX NOTE 11.

WITH GUARDS PER CONSTRUCTION HEX NOTE 11.

HANDRAIL HEIGHTS - O.B.C. 9.8.7. - REQUIRED AS PER 9.8.7.1.(3)

MIN. HEIGHT AT STAIRS OR RAMP: 2'-10" (865)

MAX. HEIGHT AT STAIRS OR RAMP: 3'-2" (965)

MAX. HEIGHT AT LANDING: 3'-6" (1070)

STAIRS OR RAMP MIN. 7'-3" (2200) WIDE: 2'-9" (865) MIN. HEIGHT

2"x4" (38x89) SILL PLATE WITH 1/2" (12.7)Ø ANCHOR BOLTS 8" (200) LONG, EMBEDDED MIN. 4" (100) INTO CONC. @ 7"-10" (2388) O.C., CAULKING OR GASKET BETWEEN PLATE AND TOP OF FOUNDATION WALL. USE NON-SHRINK GROUT TO LEVEL SILL PLATE WHEN REQUIRED (9.23.7.)

BASEMENT INSULATION ([SB-12] 3.1.1.7.)

PROVIDE CONTINUOUS BLANKET INSULATION W/ BUILT IN 6 mil POLYETHYLENE VAPOUR BARRIER. INSULATION TO EXTEND NO MORE THAN 8" (200) ABOVE FINISHED BASEMENT FLOOR. DAMPROOFED WITH BUILDING PAPER BETWEEN THE FOUNDATION WALL AND INSULATION UP TO GRADE LEVEL.

BEARING STUD PARTITION IN BASEMENT (9.15.3.6., 9.23.10.1.) 2"x4" (38x89) STUDS @ 16" (406) O.C., 2"x4" (38x89) SILL PLATE ON DAMPPROOFING MATERIAL OR 2 mil POLYETHYLENE FILM, 1/2" (12.7) Ø ANCHOR BOLTS 8" (200) LONG, EMBEDDED 4" (100) MIN. INTO CONC. @ 7'-10" (2390) O.C. 4" (100) HIGH CONC. CURB ON CONC. FOOTING, FOR SIZE REFER TO HEX NOTE 5. ADD HORIZ. BLOCKING AT MID-HEIGHT IF WALL IS UNFINISHED.

ADJUSTABLE STEEL BASEMENT COLUMN (9.15.3.4. 9-10" (3000) MAX. SPAN BETWEEN COLUMNS, 3 1/2" (90)/Ø SINGLE TUBE
ADJUSTABLE STEEL COLUMN CONFORMING TO CAN/CGSB-7.2M, AND WITH
6"x6"x3/8" (152x152x9.5) STEEL PLATE TOP & BOTTOM. FIELD WELD BASEMENT
COLUMN CONNECTION. POURED CONCRETE FOOTING ON NATURAL
UNDISTURBED SOIL OF 75kPa OR COMPACTED ENGINEERED FILL WITH MIN.
BEARING CAPACITY OF 150kPa AS PER SOILS REPORT.

SUPPORTING 2 STOREY FLR. LOAD PROVIDE 34"x34"x16" (870x870x410) CONC. FOOTING SUPPORTING 3 STOREY FLR. LOAD PROVIDE 40"x40"x19" (1060x1060x480) CONC. FOOTING

NON-ADJUSTABLE STEEL BASEMENT COLUMN

3 1/2" (90)Ø x 0.188" (4.78) NON-ADJUSTABLE STEEL COLUMN WITH 6"x6"x3/8" (152x152x9.5) STEEL PLATE TOP & BOTTOM. FIELD WELD BASEMENT COLUMN CONNECTION. POURED CONCRETE FOOTING ON NATURAL UNDISTURBED SOIL OF 75kPa OR COMPACTED ENGINEERED FILL WITH MIN. BEARING CAPACITY OF 150kPa AS PER SOILS REPORT.

SUPPORTING 2 STOREY FLR. LOAD PROVIDE 42"x42"x18" (1070x1070x460) CONC. FOOTING SUPPORTING 3 STOREY FLR. LOAD PROVIDE 48"x48"x24" (1220x1220x610) CONC. FOOTING

NON-ADJUSTABLE STL. COLUMN AT FOUNDATION WALL

3 1/2" (90)Ø x 0.188" (4.78) NON-ADJUSTABLE STEEL COLUMN WITH 6"x6"x3/8" (152x152x9.5) STEEL TOP PLATE & 6"x4"x3/8" (152x100x9.5) BOTTOM PLATE. BASE PLATE 4-1/2"x10"x1/2" (120x250x12.7) WTH 2-1/2"Ø x 12" LONG x 2" HOOK ANCHORS (2-12.7Øx305x50). FIELD WELD COLUMN TO BASE PLATE & STEEL BM.

STEEL BEAM BEARING AT FOUNDATION WALL (9.23.8.1.) BEAM POCKET OR 8"x8" (200x200) POURED CONC. NIB WALLS, MIN. BEARING 3 1/2" (90).

WOOD STRAPPING AT STEEL BEAMS (9.23.4.3.(3.), 9.23.9.3.) 1"x3" (19x64) CONTIN. WOOD STRAPPING BOTH SIDES OF STEEL BEAM.

GARAGE SLAB (9.16., 9.35.)

4" (100) 32MPa (4640psi) CONC. SLAB WITH 5-8% AIR ENTRAINMENT ON OPT. 4" (100) COARSE GRANULAR FILL WITH COMPACTED SUB-BASE OR COMPACTED NATIVE FILL. SLOPE TO FRONT @ 1% MIN.

GARAGE TO HOUSE WALLS/CEILING (9.10.9.16.) 1/2" (12.7) GYPSUM BOARD ON WALL AND CEILING BETWEEN HOUSE AND GARAGE, PLUS REQUIRED INSULATION IN WALLS AND SPRAY FOAM FOR CEILINGS. TAPE AND SEAL ALL JOINTS GAS TIGHT.

GARAGE TO HOUSE WALLS/CEILING W/ CONTIN. INSULATION 1/2" (12.7) GYPSUM BOARD ON CEILING AND ON WALLS INSTALLED OVER 1/2 (12:7) GIT-SOUR BOARD ON CELLING AND ON WALLS INSTALLED OVER EXTERIOR TYPE RIGID INSULATION (JOINTS UNTAPED) MECHANICALLY FASTENED AS PER MANUFACTURER'S SPECIFICATIONS ON 3/8" EXTERIOR GRADE SHEATHING ON STUDS BETWEEN HOUSE AND GARAGE. PLUS REQUIRED INSULATION IN WALLS & SPRAY FOAM FOR CEILINGS. TAPE AND SEAL ALL JOINTS GAS TIGHT. (9.10.9.16.)

GARAGE DOOR TO HOUSE (9.10.9.16., 9.10.13.10., 9.10.13.15.) GAS-PROOF DOOR AND FRAME. DOOR EQUIPPED WITH SELF CLOSING DEVICE AND WEATHER STRIPPING.

EXTERIOR AND GARAGE STEPS

PRECAST CONC. STEP OR WOOD STEP WHERE NOT EXPOSED TO WEATHER.
MAX RISE 7 7/8" (200), MIN. TREAD 9 1/4" (235). FOR THE REQUIRED NUMBER
OF STEPS REFER TO SITING AND GRADING DRAWINGS. EXTERIOR CONCRETE STAIRS WITH MORE THAN 2 RISERS AND 2 TREADS SHALL BE PROVIDED WITH FOUNDATION AS REQUIRED BY ARTICLE 9.8.9.2. OR SHALL BE CANTILEVERED AS PER SUBSECTION 9.8.10.

DRYER EXHAUST

CAPPED DRYER EXHAUST VENTED TO EXT. CONFORMING TO PART 6. OBC 9.32.

ATTIC ACCESS (9.19.2.1.) (23)

ATTIC ACCESS HATCH WITH MIN. AREA OF 0.32m2 AND NO DIM. LESS THAN 21 1/2" (545) WITH WEATHER STRIPPING. HATCHWAYS TO THE ATTIC OR ROOF SPACE WILL BE FITTED WITH DOORS OR COVERS AND WILL BE INSULATED WITH MIN. R20 (RSI 3.52) ([SB-12] 3.1.1.8.(1))

FIREPLACE CHIMNEYS (9.21.)

TOP OF FIREPLACE CHIMNEY SHALL BE 2'-11" (889) ABOVE THE HIGHEST POINT AT WHICH IT COMES IN CONTACT WITH THE ROOF AND 2-0" (610) ABOVE THE ROOF SURFACE WITHIN A HORIZ. DISTANCE OF 10-0" (3048) FROM THE CHIMNEY

LINEN CLOSET

PROVIDE 4 SHELVES MIN. 14" (356) DEEP.

MECHANICAL VENTILATION (9.32.1.3.) MECHANICAL EXHAUST FAN, VENTED TO EXTERIOR, TO PROVIDE AT LEAST

ONE AIR CHANGE PER HOUR. SEE GENERAL NOTE 2.3 PARTY WALL BEARING (9.23.8)

12"x12"x5/8" (305x305x15.9) STEEL PLATE FOR STEEL BEAMS AND 12"x12"x1/2" (305x305x12.7) STEEL PLATE FOR WOOD BEAMS BEARING (MIN. 3-1/2" (89)) ON CONC. BLOCK PARTY WALL, ANCHORED WITH 2-3/4" (2-19) x 8" (200) LONG GALV. ANCHORS WITHIN SOLID BLOCK COURSE. LEVEL W/ NON-SHRINK GROUT. REFER TO NOTE SOLID BEARING (SECTION 3.0) FOR WD. STUD PARTY WALL.

WOOD FRAMING IN CONTACT TO CONCRETE

WOOD BEARING WALLS, THE UNDERSIDE OF BUILT-UP WOOD POSTS AND SILLS SHALL BE WRAPPED WITH 2 mil POLY. STRIP FOOTINGS SUPPORTING THE FOUNDATION WALL SHALL BE WIDENED 6" (152) BELOW THE BEARING WALL AND/OR WOOD POST. (9.17.4.3.)

BUILT-UP WOOD POST AND FOOTING (9.17.4.1., 9.15.3.7.) 3-2"x6" (3-38x140) BUILT-UP WOOD POST (UNLESS OTHERWISE NOTED) ON METAL BASE SHOE ANCHORED TO CONC. WITH 1/2" (12.7) Ø BOLT, 24"x24"x12" (610x610x305) CONC. FOOTING OR AS PROVIDED ON PLAN. REFER TO NOTE 28

STEP FOOTINGS (9.15.3.9.)

MIN. HORIZ. STEP = 23 5/8" (600). MAX. VERT. STEP = 23 5/8" (600).

CONC. PORCH SLAB (9.16.4.)

MIN. 4" (100) CONCRETE SLAB ON GRADE ON 4" (100) COARSE GRANULAR FILL, REINFORCED WITH 6x6xW2.9xW2.9 MESH PLACED NEAR MID-DEPTH OF SLAB. CONC. STRENGTH 32MPa (4640psi) WITH 5-8% AIR ENTRAINMENT ON COMPACTED SUB-GRADE.

FURNACE VENTING (9.32.) DIBECT VENT FURNACE TERMINAL MIN. 35-0" (915) FROM A GAS REGULATOR

MIN. 12" (305) ABOVE FIN. GRADE, FROM ALL OPENINGS, EXHAUST AND INTAKE VENTS. HRV INTAKE TO BE A MIN. OF 6'-0" (1830) FROM ALL EXHAUST TERMINALS. REFER TO GAS UTILIZATION CODE.

FIREPLACE VENTING (9.32.3.) DIRECT VENT GAS FIREPLACE VENT TO BE A MIN. 12" (305) FROM ANY OPENING AND ABOVE FIN. GRADE. REFER TO GAS UTILIZATION CODE.

FLOOR FRAMING (9.23.3.5., 9.23.9.4., 9.23.14.) T&G SUBFLOOR ON WOOD FLOOR JOISTS. FOR CERAMIC TILE APPLICATION SEE O.B.C. 9,30.6. ALL JOISTS WHERE REQUIRED TO BE BRIDGED WITH 2"x2" (38x38) CROSS BRACING OR SOLID BLOCKING @ 6-11" (2108) O.C. MAX. ALL JOISTS TO BE STRAPPED WITH 1"x3" (19x64) @ 6-11" (2108) O.C. UNLESS A PANEL TYPE CEILING FINISH IS APPLIED.

HEADER CONSTRUCTION

PROVIDE CONTINUOUS APPROVED AIR/VAPOUR BARRIER (HEADER WRAP) UNDER THE SILL PLATE, AROUND THE RIM BOARD AND UNDER THE BOTTOM PLATE. THE HEADER WRAP SHALL EXTEND 6" (152) BELOW THE TOP OF FOUNDATION WALL AND WILL BE SEALED TO THE CONCRETE FOUNDATION WALL EXTEND HEADER WRAP 6" (152) UP THE INTERIOR SIDE OF THE STUD WALL AND OVERLAP WITH THE VAPOUR BARRIER AND SEAL THE JOINT, ALL EDGES/JOINTS MUST BE MECHANICALLY CLAMPED.

EXPOSED BUILDING FACE w/ LIMITING DISTANCE <= 3'-11" (1.20m) WALL ASSEMBLY CONTAINS INSULATION CONFORMING TO CAN/ULC-S702 & HAVING A MASS OF NOT LESS THAN 1.22 kg/m2 OF WALL SURFACE AND 1/2" (12.7) TYPE X GYPSUM WALLBOARD INTERIOR FINISH. EXTERIOR CLADDING MUST BE NON-COMBUSTIBLE. WALL ASSEMBLY REQUIRES TO HAVE A FIRE RESISTANCE RATING OF NOT LESS THAN 45 MINUTES & CONFORMING TO O.B.C. (9.10.14. OR 9.10.15.). REFER TO DETAILS FOR TYPE & SPECS. * AN OPENING IN AN EXPOSING BUILDING FACE NOT MORE THAN 20 in² (130cm²)

SHALL NOT BE CONSIDERED AN UNPROTECTED OPENING AS PER 9.10.14.6. **COLD CELLAR PORCH SLAB** (9.39.)

FOR MAX. 8'-2" (2500) PORCH DEPTH, 5" (127) 32 MPa (4640psi) CONC. SLAB W/5-8% AIR ENTRAINMENT. REINF. WITH 10M BARS @ 7 7/8" (200) O.C. EACH DIRECTION, W/ 1 1/4" (32) CLEAR COVER FROM BOTTOM OF SLAB TO FIRST LAYER OF BARS & SECOND LAYER OF BARS LAID DIRECTLY ON TOP OF LOWER LAYER IN OPPOSITE DIR. 24"x24" (610x610) 10M DOWELS @ 23 5/8" (600) O.C., ANCHORED IN PERIMETER FND. WALLS. SLOPE SLAB 1.0% FROM DOOR.

RANGE HOODS AND RANGE-TOP FANS

COOKING APPLIANCE EXHAUST FANS VENTED TO EXTERIOR MUST CONFORM TO OBC 9.32.3.9. & 9.32.3.10.

CONVENTIONAL ROOF FRAMING (9.23.13., 9.23.15.) 2"x6" (38x140) RAFTERS @ 16" (406) O.C., 2"x8" (38x184) RIDGE BOARD. 2"x4" (38x89) COLLAR TIES AT MID-SPAN. CEILING JOISTS TO BE 2"x4" (38x89) @ 16" (406) O.C. FOR MAX. 9-3" (2819) SPAN & 2"x6" (38x140) @ 16" (406) O.C. FOR MAX. SPAN 14-7" (4450). RAFTERS FOR BUILT UP ROOF OVER PRE-ENGINEERED ROOF TRUSSÉS AND OR CONVENTIONAL FRAMING TO BE 2"x4" (38x89) @ 24" (610) O.C. UNLESS OTHERWISE SPECIFIED.

TWO STOREY VOLUME SPACES (9.23.10.1., 9.23.11., 9.23.16.)

WIND LOADS WALL ASSEMBLY <= 0.5 kPA (q50) > 0.5 kPa (q50) **EXTERIOR** STUDS SPACING MAX HEIGHT SPACING MAX HEIGHT 2" (305) O.C. 18'-4" (5588) 8' (200) O.C. 18'-4" (5588) **BRICK** 2-38x140 SIDING 6" (406) O.C. 18'-4" (5588) 12" (305) O.C. 18'-4" (5588) 12" (305) O.C. 21'-0" (6400) 12" (305) O.C. 21'-0" (6400) (2-38x140) 16" (406) O.C. 21'-0" (6400) 16" (406) O.C. 21'-0" (6400) SIDING

STUDS ARE TO BE CONTINUOUS, C/W 3/8" (9.5) THICK EXTERIOR PLYWOOD SHEATHING, PROVIDE SOLID WOOD BLOCKING BETWEEN WOOD STUDS @ 4'-0" (1220) O.C. VERTICALLY.

- FOR HORIZ. DISTANCES LESS THAN 9-6" (2896) PROVIDE 2"x6" (38x140) STUDS @ 16' (406) O.C. WITH CONTIN. 2-2"x6" (2-38x140) TOP PLATE + 1-2"x6" (1-38x140) BOTTOM PLATE & MIN. OF 3-2"x8' (3-38x184) CONT. HEADER AT GROUND FLOOR CEILING LEVEL TOE-NAILED & GLUED AT TOP, BOTTOM PLATES & HEADERS.

CONSTRUCTION NOTES 1

UNIT 2202 - T2

REV.2019.05.17

19 of 20

ROYAL PINE HOMES-FORESTSIDE ESTATES PH2 - 215044 "MANOR OF CLAIREVILLE", BRAMPTON, ONT.

3/16"=1'-0" NS MM/DS 215044WS2202.T2.DWG 8966 Woodbine Ave, Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326

STAMP

HUNT DESIGN ASSOCIATES INC. All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A.), Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature.)

INFORMATION . **DEREK SANTOS** 37308

1 HR. PARTY WALL (CONC. BLOCK) ([SB-3] WALL TYPE 'B6e' & 'B1b') 1/2" (12.7) GYPSUM SHEATHING ON EACH SIDE ON 2"x2" (38x38) VERTICAL WD. STRAPPING @ 24" (610) O.C. ON 8" (200) CONC. BLOCK FILL STRAPPING CAVITY EACH SIDE WITH AT LEAST 90% OF ABSORPTIVE MATERIAL PROCESSED FROM ROCK, SLAG OR GLASS. TAPE, FILL & SAND ALL GYPSUM JOINTS. EXPOSED BLOCK MUST BE SEALED W/ 2 COATS OF PAINT OR FURRED WITH 2"x2" (38x38) WD. STRAPPING & 1/2" (12.7) GYPSUM SHEATHING.

〈 40 `

1 HR. PARTY WALL (DOUBLE STUD) ([SB-3] WALL TYPE 'W13c') 5/8" (15.9) TYPE 'X' GYPSUM SHEATHING ON EXTERIOR SIDE OF 2 ROWS OF "2"A" (38x89) STUDS @ 16" (406) O.C., MIN. 1" (25) APART ON SEPARATE 2"x4" (38x89) SILL PLATES. FILL ONE SIDE OF STUD CAVITY WITH AT LEAST 90% OF ABSORPTIVE MATERIAL PROCESSED FROM ROCK, SLAG OR GLASS. TAPE FILL AND SAND ALL GYPSUM JOINTS.

 \langle 40Aangle

2 HR. FIREWALL ([SB-3] WALL TYPE 'B6e' & 'B1b')

1/2" (12.7) GYPSUM SHEATHING ON EACH SIDE ON 2"X2" (38x38) VERTICAL WOOD STRAPPING @ 24" (610) O.C ON 8" (200) CONC. BLOCK 75% SOLID. FILL STRAPPING CAVITY EACH SIDE WITH AT LEAST 90% OF ABSORPTIVE MATERIAL PROCESSED FROM ROCK, SLAG OR GLASS. TAPE, FILL & SAND ALL GYPSUM JOINTS. AT UNFINISHED AREAS, EXTERIOR FACE OF CONC. BLOCK TO BE SEALED WITH 2 COATS OF PAINT. GYPSUM SHEATHING TO BE ATTACHED TO CONC. BLOCK. (REFER TO DETAILS)

STUCCO WALL CONSTRUCTION

STUCCO FINISH CONFORMING TO O.B.C. SECTION 9.28. AND APPLIED PER STOCCO FINISH CONFORMING TO U.B.C. SECTION 9.28. AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 1 1/2" (38) E.I.F.S. (MINIMUM) ON APPROVED DRAINAGE MAT ON 1/2" (12.7) DENSGLASS GOLD GYPSUM BOARD ON 2"x6" (38x140) SPRUCE STUDS @ 16" (406) O.C., INSULATION, APPROVED 6 MIL. POLYETHYLENE VAPOUR BARRIER, 1/2" (12.7) GYPSUM WALLBOARD INT. FINISH. (REFER TO 35 NOTE AS REQUIRED)

STUCCO WALL CONSTRUCTION W/ CONTIN. INSULATION STUCCO FINISH CONFORMING TO O.B.C. SECTION 9.28. AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 1 1/2" (38) E.I.F.S. (MINIMUM) ON APPROVED DRAINAGE MAT ON APPROVED AIR/WATER BARRIER AS PER O.B.C. 9.27.3. ON EXTERIOR TYPE RIGID INSULATION (JOINTS UNTAPED)
MECHANICALLY FASTENED AS PER MANUFACTURER'S SPECIFICATIONS, ON 7/16" EXTERIOR TYPE SHEATHING ON 2"x6" (38x140) SPRUCE STUDS @ 16" (406) O.C., INSULATION, APPROVED 6 MIL. POLYETHYLENE VAPOUR BARRIER, 1/2" (12.7) GYPSUM WALLBOARD INT. FINISH. (REFER TO 35 NOTE AS REQUIRED)

STUCCO WALL @ GARAGE CONST.

STUCCO FINISH CONFORMING TO O.B.C. SECTION 9.28. AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 1 1/2" (38) E.F.I.S (MINIMUM) ON APPROVED DRAINAGE MAT ON 1/2" (12.7) DENSGLASS GOLD GYPSUM BRD. ON STUDS CONFORMING TO O.B.C (9.23.10.1.) & SECTION 1.1., 1/2" (12.7) GYPSUM WALLBOARD INT. FINISH. (REFER TO 35 NOTE AS REQ.)

WALLBOARD INI. FINISH, (REPER TO 35 NOTE AS REQ.)
**** FOR DWELLINGS USING CONTIN. INSULATION CONSTRUCTION,
PROVIDE APPROVED DRAINAGE MAT ON 7/16" (11) EXTERIOR TYPE SHEATHING
OVER FURRING (AS REQ.) AND STUDS IN LIEU OF 1 1/2" (38) E.F.I.S (MINIMUM)
ON APPROVED DRAINAGE MAT ON 1/2" (12.7) DENSGLASS GOLD GYPSUM BRD.

UNSUPPORTED FOUNDATION WALLS (9.15.4.2.)

REINFORCING AT STAIRS AND SUNKEN FLOOR AREAS 2-20M BARS IN TOP PORTION OF WALL (UP TO 8-0" OPENING) 3-20M BARS IN TOP PORTION OF WALL (8-0" TO 10'-0" OPENING) - BARS STACKED VERTICALLY AT INTERIOR FACE OF WALL

- BARS STACKED VERTICALLY AT INTERIOR FACE OF WALL REINFORCING AT BASEMENT WINDOWS

2-15M HORIZ. REINFORCING ON THE INSIDE AND OUTSIDE FACE OF THE FOUNDATION WALL BELOW THE WIN. SILL. EXTEND BARS 24" (610) BEYOND THE OPENING, 2-15M VERTICAL REINFORCING ON THE INSIDE AND OUTSIDE FACE OF THE FOUNDATION WALL ON EACH SIDE OF THE WINDOW OPENING.

- BARS TO HAVE MIN. 2" (50) CONC. COVER - BARS TO EXTEND 2'-0" (610) BEYOND BOTH SIDES OF OPENING

STUD WALL REINFORCEMENT

PROVIDE STUD WALL REINFORCEMENT IN MAIN BATHROOM CONFORMING TO O.B.C. (9.5.2.3.(1) AND 3.8.3.8.(3)) (REFER TO DETAILS)

WINDOW WELLS

WHERE A WINDOW OPENS INTO A WINDOW WELL. A CLEARANCE OF NOT WHERE A WINDOW WELL SINTO A WINDOW WELL, A CLEARANCE OF NOVELESS THAN 21 5/8" (550) SHALL BE PROVIDED IN FRONT OF THE WINDOW. EVERY WINDOW WELL SHALL BE DRAINED TO THE FOOTING LEVEL OR OTHER SUITABLE LOCATION WITH A 4" (100) WEEPING TILE C,W A FILTER CLOTH WRAP AND FILLED WITH CRUSHED STONE. (9.9.10.1.(5), 9.14.6.3.)

SLOPED CEILING CONSTRUCTION ([SB-12] 2.1.1.7., 9.23.4.2.) 2"x12" (38x286) ROOF JOISTS @ 16" (406) O.C. MAX. (UNLESS OTHERWISE NOTED) W/ 2"x2" (38x38) PURLINS @ 16" (406) O.C. PERPENDICULAR TO ROOF JOIST (PURLINS NOT REQ. W/ SPRAY FOAM), W/ INSULATION BETWEEN JOIST (PURLINS NOT REQ. W/ SPRAY FOAM), W/ INSULATION BETWEEN JOIST 6 mil POLYETHYLENE VAPOUR BARRIER, 1/2" (12.7) GYPSUM WALLBOARD INT. FINISH OR APPROVED EQ. INSULATION VALUE DIRECTLY ABOVE THE INNER SURFACE OF EXTERIOR WALLS SHALL NOT BE LESS THAN R20 (3.52 RSI).

FLAT ROOF/BALCONY CONSTRUCTION

WATERPROOFING MEMBRANE FULLY ADHERED TO 5/8" (15.9) T&G EXTERIOR WATERPROOFING MEMBRANE FULLY ADHERED TO 5/8" (15.9) T&G EXTERIOR GRADE PLYWOOD SHEATHING ON 2*x2" (38x38) PURLIN'S ANGLED TOWARDS SCUPPER @ 2% MINIMUM LAID PERPENDICULAR TO 2*x8" (38x184) FLOOR JOISTS @ 16" (406) O.C. (UNLESS OTHERWISE NOTED). BUILT UP CURB TO BE 4" (100) MIN. ABOVE FINISHED BALCONY FLOOR. CONTINUOUS 'L' TRIM DRIP EDGE TO BE PROVIDED ON OUTSIDE FACE OF CURB. SCUPPER DRAIN TO BE LOCATED 24" (610) MIN. AWAY FROM HOUSE. PREFINISHED ALUMINUM OR PANEL FOR UNDERSIDE OF SOFFIT (9.23.2.3). REMOVE CURB WHERE REQ.

BALCONY CONDITION

SEE FLAT ROOF/BALCONY CONSTRUCTION NOTE. INCLUDE 2"x4" (38x89) PT. DECKING W/ 1/4" (6.4) GAPS LAID FLAT PARALLEL TO JOISTS ON 2"x4" (38x89) PT. SLEEPERS @ 12" (305) O.C. LAID FLAT PERPENDICULAR TO JOISTS

BALCONY OVER HEATED SPACE CONDITION

SEE FLAT ROOF/BALCONY CONSTRUCTION NOTE FOR ASSEMBLY. REFER TO PLANS FOR FLOOR JOIST SIZE & REFER TO HEX NOTE 9 FOR INSULATION AND INTERIOR FINISH

BARREL VAULT CONSTRUCTION 〈 47 `

CANTILEVERED 2"X4" (38X89) SPACERS LAID FLAT ON 2"X10" (38X235) SPR. #2 ROOF JOIST NAILED TO BUILT-UP 3-3/4" (19) PLYWOOD HEADER PROFILED FOR BARREL, SPRAY FOAM INSULATION BETWEEN JOISTS W/ GYPSUM BOARD. INTERIOR FIN. (REFER TO DETAILS)



STAMP FOR STRUCTURAL ONLY, NOT INCLUDING PRE-ENGINEERED ROOF OR FLOOR SYSTEMS

INFORMATION DEREK SANTOS 37308 SECTION 1.1. WALL STUDS

REFER TO THIS CHART FOR STUD SIZE & SPACING AS REQUIRED FOR EXTERIOR WALLS ONLY. REFER TO SITING & GRADING PLAN OF THIS UNIT FOR CONFIRMATION OF TOP OF FOUNDATION WALL AND ADDITIONAL INFORMATION.

REFER TO SB-12 ENERGY EFFICIENCY DESIGN MATRIX ON THE TITLE PAGE FOR ALL VALUES AS REQUIRED PER 3.1.1., 3.1.2., 3.1.3. OF THE OBC.

1D

1E

2

3

AFF I

CRF

DO I

DRP

E.I.F.S.

ENG

BM BEAM

C/W | COMPLETE WITH

DO OVER

DROPPED

EST | ESTIMATED

FA FLAT ARCH

FD FLOOR DRAIN

FG FIXED GLASS

FLOOR

HOSE BIE

GIRDER TRUSS

HOT WATER TANK

CLASS 'B' VENT

POT LIGHT

CABLE T.V. JACK

HEAT RETURN VENTILATION UNIT

DUPLEX OUTLET (12" HIGH)

LIGHT FIXTURE (PULL CHAIN)

CENTRAL VACUUM OUTLET

SMOKE ALARM (9.10.19.)

CMD CARBON MONOXIDE ALARM (9.33.4.)

HEAVY DUTY OUTLET

FL FLUSH

FLR

GT

HB

HRV

HWT

•

0

 \Diamond

Ø60

■ SA

ENGINEERED

EXTERIOR

EXTERIOR

3.3. DOOR SCHEDULE

CONFORMING TO SECTIONS 9.5.11, 9.6., 9.7.2.1, & 9.10.13.10

2'-8" x 6'-8" x 1-3/4" (815 x 2030 x 45) INS, MIN, R4 (RSI 0.7) (SEE HEX NOTE 20)

2'-8" x 6'-8" x 1-3/4" (815 x 2030 x 45) 20 MIN. F.R.R. DOOR/FRAME WITH APP. SELF CLOSING DEVICE

INTERIOR DOORS

FOR ALL 10' CEILING CONDITIONS

EXTERIOR | 2'-8" x 6'-8" x 1-3/4" (815 x 2030 x 45) INSULATED MIN. R4 (RSI 0.7)

1A EXTERIOR 2'-10" x 6'-8" x 1-3/4" (865 x 2030 x 45) INSULATED MIN. R4 (RSI 0.7)

1B EXTERIOR 3'-0" x 6'-8" x 1-3/4" (915 x 2030 x 45) INSULATED MIN. R4 (RSI 0.7)

1C | EXTERIOR | 2'-6" x 6'-8" x 1-3/4" (760 x 2030 x 45) INSULATED MIN. R4 (RSI 0.7)

INTERIOR | 2'-8" x 6'-8" x 1-3/8" (815 x 2030 x 35)

INTERIOR 2'-6" x 6'-8" x 1-3/8" (760 x 2030 x 35) 3A INTERIOR 2'-4" x 6'-8" x 1-3/8" (710 x 2030 x 35)

4 INTERIOR 2'-0" x 6'-8" x 1-3/8" (610 x 2030 x 35)

4A INTERIOR 2'-2" x 6'-8" x 1-3/8" (660 x 2030 x 35)

5 INTERIOR 1'-6" x 6'-8" x 1-3/8" (460 x 2030 x 35)

ABOVE FINISHED FLOOR

BREM BEAM BY FLOOR MANUFACTURER

BG FIXED GLASS W/ BLACK BACKING

BBRM BEAM BY ROOF MANUFACTURER

DJ/TJ DOUBLE JOIST/ TRIPLE JOIST

CONVENTIONAL ROOF FRAMING

EXTERIOR INSULATION FINISH SYSTEM

EXTERIOR 3'-0" x 8'-0" x 1-3/4" (915 x 2440 x 45) INSULATED MIN. R4 (RSI 0.7)

3.4. ACRONYMS

JST JOIST

LIN

OTB/A

PL

PLT

PT

PTD

PWD

RWL

SB

SBFA

SJ

SPR

STL STEEL

T/O

TYP

U/S

WD

WIC

WP

(2)

æ.å

∨§

-6

Ó

PROVIDE ONE PER FLOOR, NEAR THE STAIRS CONNECTING THE FLOOR LEVEL. ALARMS ARE TO BE INSTALLED IN EACH SLEEPING ROOM AND IN A LOCATION BETWEEN

SLEEPING ROOMS AND CONNECTING HALLWAYS AND WIRED TO BE INTERCONNECTED TO ACTIVATE ALL ALARMS IF ONE SOUNDS. ALARMS ARE TO BE CONNECTED TO AN

**CHECK LOCAL BY-LAWS FOR REQUIREMENTS ** A CARBON MONOXIDE ALARM(S)
CONFORMING TO CAN/CGA-6.19 SHALL BE INSTALLED ON OR NEAR THE CEILING IN EACH

DWELLING UNIT ADJACENT TO EACH SLEEPING AREA. CARBON MONOXIDE ALARM(S) SHALL BE PERMANENTLY WIRED WITH NO DISCONNECT SWITCH, WITH AN ALARM THAT IS

THE WIDTH OF A WOOD COLUMN SHALL NOT BE LESS THAN THAN THE WIDTH OF SUPPORTED MEMBER. BUILT-UP WOOD COLUMNS SHALL BE NAILED TOGETHER WITH NOT LESS THAN 3" (76) NAILS SPACED NOT MORE THAN 11 3/4" (300) O.C. THE NUMBER

OF STUDS IN A WALL DIRECTLY BELOW A GIRDER TRUSS OR ROOF BEAM SHALL

TWO STOREY VOLUME SPACE. SEE CONSTRUCTION NOTE 39.

EXPOSED BUILDING FACE -O.B.C. 9.10.14. OR 9.10.15.
REFER TO HEX NOTE 35. & DETAILS FOR TYPE AND SI

1 HR. PARTY WALL

REFER TO HEX NOTE 40.

SECTION 4.0. CLIMATIC DATA

WIND LOAD (q50) (SB-1.2.):

DESIGN SNOW LOAD (9.4.2.2.):

SOLID BEARING (BUILT-UP WOOD COLUMNS AND STUD POSTS)

VARYING PLATES, BUILT-OUT FLOORS, BEARING WALLS, ICE & WATER SHIELD

2 HR. FIREWALL

REFER TO HEX NOTE 40A.

1.12 **kPa**

REFER TO HEX NOTE 35. & DETAILS FOR TYPE AND SPECIFICATIONS.

AUDIBLE WITHIN SLEEPING ROOMS WHEN THE INTERVENING DOORS ARE CLOSED.

ELECTRICAL CIRCUIT AND WITH A BATTERY BACKUP. ALARM SIGNAL SHALL MEET TEMPORAL SOUND PATTERNS MIN. ALARMS SHALL HAVE A VISUAL SIGNALLING

COMPONENT AS PER THE "NATIONAL FIRE ALARM AND SIGNALING CODE 72".

3.5. SYMBOLS

ALL ELECTRICAL FACILITIES SHALL BE INSTALLED IN ACCORDANCE WITH SECTION 9.34.

LINEN CLOSET

POINT LOAD

PLATE

PAINTED

LAMINATED VENEER LUMBER

OPEN TO BELOW/ABOVE

PRESSURE TREATED

RAIN WATER LEADER

SOLID BEARING WOOD POST

POWDER ROOM

SB FROM ABOVE

SINGLE JOIST

SPRUCE

TOP OF

TYPICAL

WOOD

UNDERSIDE

WALK IN CLOSET

WEATHER PROOF

EXHAUST VENT

SWITCH (2/3/4 WAY)

TELEPHONE JACK

DUPLEX OUTLET (HEIGHT AS NOTED A.F.F.

LIGHT FIXTURE (CEILING MOUNTED)

LIGHT FIXTURE (WALL MOUNTED)

CHANDELIER (CEILING MOUNTED)

ROOF TRUSS

- IF STUD WALL HEIGHT EXCEEDS MAX. UNSUPPORTED HEIGHT, WALL NEEDS TO BE

| The view of the vi | | | | | | | |
|--|--|-----------------------------------|-----------------------------------|-----------------------------------|--|--|--|
| SIZE | & SPACING OF STUDS: (OBC REFERENCE - TABLE 9.23.10.1.) | | | | | | |
| MIN. | | SUPPORTED LOADS (EXTERIOR) | | | | | |
| STUD SIZE. | ROOF w/ OR w/o ATTIC | ROOF w/ OR w/o ATTIC & 1 FLOOR | ROOF w/ OR w/o ATTIC & 2 FLOOR | ROOF w/ OR w/o ATTIC & 3 FLOOR | | | |
| in (mm) | MAX. STUD SPACING, in (mm) O.C. | | | | | | |
| I () | N | MAX. UNSUPPOR | TED HGT., ft-in (m | 1) | | | |
| 2"x4" | 24" (610) | 16" (405) | 12" (305) | N/A | | | |
| (38x89) | 9'-10" (3.0) | 9'-10" (3.0) | 9'-10" (3.0) | N/A | | | |
| 2"x6" | (6" - 24" (610) 16" (406) 1 | | | | | | |
| (38x140) | - | 9'-10" (3.0) | 11'-10" (3.6) | 5'-11" (1.8) | | | |

SECTION 2.0. GENERAL NOTES

2.1. WINDOWS

EXCEPT WHERE A DOOR ON THE SAME FLOOR LEVEL AS THE BEDROOM PROVIDES DIRECT ACCESS TO THE EXTERIOR, EVERY FLOOR LEVEL CONTAINING A BEDROOM IS TO HAVE AT LEAST ONE OUTSIDE WINDOW W/ MIN. 0.35m2 UNOBSTRUCTED OPEN PORTION W/ NO DIMENSION LESS THAN 1'-3" (380), CAPABLE OF MAINTAINING THE OPENING WITHOUT THE NEED FOR ADDITIONAL SUPPORT, CONFORMING TO 9.9.10. 2) WINDOW GUARDS: A GUARD OR A WINDOW WITH A MAXIMUM RESTRICTED. OPENING WIDTH OF 4" (100) IS REQUIRED WHERE THE TOP OF THE WINDOW SILL IS LOCATED LESS THAN 1'-7" (480) ABOVE FIN. FLOOR AND THE DISTANCE FROM THE FINISHED FLOOR TO THE ADJACENT GRADE IS GREATER THAN 5'-11" (1800). (9.8.8.1.) 3) WINDOWS IN EXIT STAIRWAYS THAT EXTEND TO LESS THAN 2'-11" (900) [3'-6" (1070) FOR ALL OTHER BUILDINGS] SHALL BE PROTECTED BY GUARDS IN ACCORDANCE WITH NOTE #2 (ABOVE). OR THE WINDOW SHALL BE NON-OPERABLE AND DESIGNED TO WITHSTAND THE SPECIFIED LOADS FOR BALCONY GUARDS AS PROVIDED IN

4.1.5.15 OR 9.8.8.2 4) REFER TO TITLE PAGE FOR MAX. U-VALUE REQUIREMENTS

2.2. CEILING HEIGHTS

THE CEILING HEIGHTS OF ROOMS AND SPACES SHALL CONFORM TO TABLE 9.5.3.1.

| ROOM OR SPACE | MINIMUM HEIGHTS |
|---|--|
| LIVING ROOM, DINING ROOM AND KITCHEN | 7'-7" OVER 75% OF REQUIRED FLOOR AREA WITH A CLEAR HEIGHT OF 6'-11" AT ANY POINT |
| BEDROOM | 7'-7" OVER 50% OF REQUIRED FLOOR AREA OR 6'-11" OVER ALL OF THE REQUIRED FLOOR AREA. |
| BASEMENT | 6'-11" OVER AT LEAST 75% OF THE BASEMENT AREA EXCEPT THAT UNDER BEAMS AND DUCTS THE CLEARANCE IS PERMITTED TO BE REDUCED TO 6'-5". |
| BATHROOM, LAUNDRY AREA ABOVE GRADE | 6'-11" IN ANY AREA WHERE A PERSON WOULD NORMALLY BE STANDING |
| FINISHED ROOM NOT MENTIONED ABOVE | 6-11" |
| MEZZANINES | 6'-11" ABOVE & BELOW FLOOR ASSEMBLY (9.5.3.2.) |
| STORAGE GARAGE | 6'-7" (9.5.3.3.) |

2.3. MECHANICAL / PLUMBING

1) MECHANICAL VENTILATION IS REQUIRED TO PROVIDE 0.7 AIR CHANGE PER HOUR IF NOT AIR CONDITIONED 1 PER HOUR IF AIR CONDITIONED AVERAGED OVER 24 HOURS. WHEN A VENTILATION FAN (PRINCIPAL EXHAUST) IS REQUIRED, CONFORM TO OBC 9.32.3.4. WHEN A HRV IS REQUIRED, CONFORM TO 9.32.3.11. REFER TO MECHANICAL DRAWINGS.

2) REFER TO HOT WATER TANK MANUFACTURER SPECS. CONFORM TO OBC 9.31.6. 3) REFER TO TITLE PAGE FOR SPACE HEATING EQUIPMENT, HRV AND DOMESTIC HOT WATER HEATER MINIMUM EFFICIENCIES.

4) DRAIN WATER HEAT RECOVERY UNIT(S) WILL BE INSTALLED CONFORMING TO THE RÉQUIREMENTS OF 3.1.1.12. OF THE O.B.C.

2.4. LUMBER

1) ALL LUMBER SHALL BE SPRUCE No.2 GRADE OR BETTER, UNLESS NOTED OTHERWISE. 2) STUDS SHALL BE STUD GRADE SPRUCE, UNLESS NOTED OTHERWISE.

3) LUMBER EXPOSED TO THE EXTERIOR TO BE SPRUCE No. 2 GRADE PRESSURE TREATED OR CEDAR LIMITES MOTED OF LEGISLATION. EATED OR CEDAR, UNLESS NOTED OTHERWISE

4) ALL LAMINATED VENEER LUMBER (LVL) BEAMS, GIRDER TRUSSES, AND METAL HANGER CONNECTIONS SUPPORTING ROOF FRAMING TO BE DESIGNED & CERTIFIED BY FLOOR AND ROOF TRUSS MANUFACTURER. JOIST HANGERS: PROVIDE APPROVED METAL HANGERS FOR ALL JOISTS AND

BUILT-UP WOOD MEMBERS INTERSECTING WITH FLUSH BUILT-UP WOOD MEMBERS. 6) WOOD FRAMING NOT TREATED WITH A WOOD PRESERVATIVE, IN CONTACT WITH CONCRETE, SHALL BE SEPARATED FROM THE CONC. BY AT LEAST 2 mil POLYETHYL. FILM, No. 50 (45lbs) ROLL ROOFING OR OTHER DAMPPROOFING MATERIAL, EXCEPT WHERE THE WOOD MEMBER IS AT LEAST 6" (152) ABOVE THE GROUND.

2.5. STEEL (9.23.4.3.)

T) STRUCTURAL STEEL SHALL CONFORM TO CAN/CSA-G40-21 GRADE 300W. HOLLOW STRUCT. SECTIONS SHALL CONFORM TO CAN/CSA-G40-21 GRADE 350W CLASS "H". 2) REINFORCING STEEL SHALL CONFORM TO CSA-G30-18M GRADE 400R.

2.6. FLAT ARCHES

1) FOR 8'-0" (2440) CEILINGS, FLAT ARCHES SHALL BE 6'-10" (2080) A.F.F. 2) FOR 9'-0" (2740) CEILINGS, FLAT ARCHES SHALL BE 7'-10" (2400) A.F.F. 3) FOR 10'-0" (3040) CEILINGS, FLAT ARCHES SHALL BE 8'-6" (2600) A.F.F.

2.7. ROOF OVERHANGS

ALL ROOF OVERHANGS SHALL BE 1'-0" (305). UNLESS NOTED OTHERWISE.

2.8. FLASHING (9.20.13., 9.26.4, & 9.27.3.) 1) FLASHING MATERIALS & INSTALLATION SHALL CONFORM TO O.B.C.

IT THE BUILDING SHALL BE LOCATED OR THE BUILDING SITE GRADED SO THE WATER WILL NOT ACCUMULATE AT OR NEAR THE BUILDING AND WILL NOT ADVERSELY AFFECT ADJACENT PROPERTIES. CONFORM TO 9.14.6.

2.10. ULC SPECIFIED ASSEMBLIES

ALL REQUIRED INDIVIDUAL COMPONENTS THAT FORM PART OF ANY 'ULC LISTED ASSEMBLY', SPECIFIED WITHIN THESE DRAWINGS, CANNOT BE ALTERED OR SUBSTITUTED FOR ANY OTHER MATERIAL/PRODUCT OR SPECIFIED MANUFACTURER THAT IS IDENTIFIED IN THAT SPECIFIED U.C. LISTING. THERE SHALL BE NO DEVIATIONS UNDER ANY CIRCUMSTANCES IN ANY 'ULC LISTED ASSEMBLY' IDENTIFIED IN THESE DRAWINGS.

SECTION 3.0. LEGEND

3,1, WOOD LINTELS AND BUILT-UP WOOD (DIVISION B PART 9. TABLES A8 TO A10 AND A12, A15 & A16)

23.4.2.(3), 9.23.4.2.(4), 9.23.12.3.(1),(3), 9.23.13.8.(2)

| 2"x8" SPRUCE #2 | | #2 2"x10" SPRUCE #2 | | | 2"x12" SPRUCE #2 |
|-----------------|---------------------|---------------------|----------------------|-------|---------------------|
| L1 | 2/2"x8" (2/38x184) | L3 | 2/2"x10" (2/38x235) | L5 | 2/2"x12" (2/38x286) |
| B1 | 3/2"x8" (3/38x184) | ВЗ | 3/2"x10" (3/38x235) | B5 | 3/2"x12" (3/38x286) |
| B2 | 4/2"x8" (4/38x184) | B4 | 4/2"x10" (4/38x235) | B6 | 4/2"x12" (4/38x286) |
| B7 | 5/2"x8" (5/38x184) | B8 | 5/2"x10" (5/38x235) | В9 | 5/2"x12" (5/38x286) |
| | Е | NGIN | EERED LUMBER SCHEDU | LE | |
| | 1 3/4" x 9 1/2" LVL | | 1 3/4" x 11 7/8" LVL | | 1 3/4" x 14" LVL |
| LVL2 | 1-1 3/4"x9 1/2" | LVL3 | 1-1 3/4"x11 7/8" | LVL10 | 1-1 3/4"x14" |
| LVL4 | 2-1 3/4"x9 1/2" | LVL6 | 2-1 3/4"x11 7/8" | LVL11 | 2-1 3/4"x14" |
| LVL5 | 3-1 3/4"x9 1/2" | LVL7 | 3-1 3/4"x11 7/8" | LVL12 | 3-1 3/4"x14" |
| LVL8 | 4-1 3/4"x9 1/2" | LVL9 | 4-1 3/4"x11 7/8" | LVL13 | 4-1 3/4"x14" |
| | | | | | |

3.2. STEEL LINTELS SUPPORTING MASONRY VENEER (DIVISION B PART 9. TABLE 9.20.5.2.B.)

FORMING PART OF SENTENCE 9.20.5.2.(2) & 9.20.5.2.

| CODE | SIZE | BRICK | STONE |
|------|--|-----------------|----------------|
| L7 | 3 1/2" x 3 1/2" x 1/4" (89 x 89 x 6.4) | 8'-1" (2.47m) | 7'-6" (2.30m) |
| L8 | 4" x 3 1/2" x 1/4" (102 x 89 x 6.4) | 8'-9" (2.66m) | 8'-1" (2.48m) |
| L9 | 4 7/8" x 3 1/2" x 5/16" (127 x 89 x 7.9) | 10'-10" (3.31m) | 10'-1" (3.03m) |
| L10 | 4 7/8" x 3 1/2" x 3/8" (127 x 89 x 11) | 11'-5" (3.48m) | 10'-7" (3.24m) |
| L11 | 5 7/8" x 3 1/2" x 3/8" (152 x 89 x 11) | 12'-6" (3.82m) | 11'-7" (3.54m) |
| L12 | 7 1/8" x 4" x 3/8" (178 x 102 x 11) | 14'-1" (4.30m) | 13'-1" (3.99m) |

CONTRACTOR MUST VERIEY ALL DIMENSIONS ON THE JOB, REPORT ANY DISCREPANCIES TO HUNT DESIGN ASSOCIATES INC. (H.D.A.I.) BEFORE PROCEEDING WITH THE WORK, ALL THE DRAY SPECIFICATIONS ARE THE INSTRUMENTS OF SERVICE AND ARE THE PROPERTY OF H.D.A.I. ALL CONSTRUCTION TO ADHERE TO THESE PLANS AND SPECIFICATIONS AND TO CONFORM TO THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE CODES AND AUTHORITIES HAVING JURISDIC THESE REQUIREMENTS ARE TO BE TAKEN AS MINIMUM SPECIFICATIONS. ONT. REG. 332/12.


CONSTRUCTION NOTE REVISION DATE: January 1, 2017 - UPDATED to 2017 OBC

CONSTRUCTION NOTES 2

REV.2019.05.17

20 of 20

ROYAL PINE HOMES-FORESTSIDE ESTATES PH2 - 215044 UNIT 2202 - T2



"MANOR OF CLAIREVILLE", BRAMPTON, ONT.

STAME

8966 Woodbine Ave, Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326 www.huntdesign.ca

HUNT DESIGN ASSOCIATES INC. 19695 All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A.), Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature.