

Schedule 1: Designer Information

Use one form for each individual who reviews and takes responsibility for design activities with respect to the project.

A. Project Information			
Building number, street name		Unit no.	Lot/con.
Municipality RICHMOND HILL	Postal code	Plan number/ other description	
B. Individual who reviews and takes responsibility for design activities			
Name MICHAEL O'ROURKE		Firm HVAC DESIGNS LTD.	
Street address 375 FINLEY AVE		Unit no. 202	Lot/con. N/A
Municipality AJAX	Postal code L1S 2E2	Province ONTARIO	E-mail info@hvacdsgns.ca
Telephone number (905) 619-2300	Fax number (905) 619-2375	Cell number ()	
C. Design activities undertaken by individual identified in Section B. [Building Code Table 3.5.2.1 OF Division C]			
☐ House ☐ Small Buildings ☐ Large Buildings ☐ Complex Buildings ☒ HVAC – House ☐ Building Services ☐ Detection, Lighting and Power ☐ Fire Protection ☐ Building Structural ☐ Plumbing – House ☐ Plumbing – All Buildings ☐ On-site Sewage Systems			
Description of designer's work HEAT LOSS / GAIN CALCULATIONS DUCT SIZING RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY RESIDENTIAL SYSTEM DESIGN per CSA-F280-12		Model: 2008 Project: CENTREFIELD (WEST GORMLEY)	
D. Declaration of Designer			
I, <u>MICHAEL O'ROURKE</u> (print name) declare that (choose one as appropriate):			
☐ I review and take responsibility for the design work on behalf of a firm registered under subsection 3.2.4. of Division C, of the Building Code. I am qualified, and the firm is registered, in the appropriate classes/categories. Individual BCIN: _____ Firm BCIN: _____			
☒ I review and take responsibility for the design and am qualified in the appropriate category as an "other designer" under subsection 3.2.5. of Division C, of the Building Code. Individual BCIN: <u>19669</u> Basis for exemption from registration and qualification: <u>O.B.C SENTENCE 3.2.4.1 (4)</u>			
☐ The design work is exempt from the registration and qualification requirements of the Building Code. Basis for exemption from registration and qualification: _____			
I certify that:			
1. The information contained in this schedule is true to the best of my knowledge. 2. I have submitted this application with the knowledge and consent of the firm.			
April 21, 2021			
Date		Signature of Designer	

NOTE:

- For the purposes of this form, "individual" means the "person" referred to in Clause 3.2.4.7(1) d) of Division C, Article 3.2.5.1. of Division C, and all other persons who are exempt from qualification under Subsections 3.2.4. and 3.2.5. of Division C.
- Schedule 1 is not required to be completed by a holder of a license, temporary license, or a certificate of authorization, issued by the Ontario Association of Architects. Schedule 1 is also not required to be completed by a holder of a license to practise, a limited license to practise, or a certificate of authorization, issued by the Association of Professional Engineers of Ontario.

Application for a Permit Construct or Demolish – Effective January 1, 2015

SITE NAME: CENTREFIELD (WEST GORMLEY)										TYPE: 2008		DATE: Apr-21		WINTER NATURAL AIR CHANGE RATE 0.236		HEAT LOSS ΔT °F. 78		CSA-F2800-1	
BUILDER: ROYAL PINE HOMES										GFA: 1672		LO# 87528		SUMMER NATURAL AIR CHANGE RATE 0.072		HEAT GAIN ΔT °F. 13		SB-12 PERFORMANCE	
ROOM USE		IMBR		ENS		BED-2		BED-3		BATH									
EXP. WALL	CLG. HT.	14	9	6	9	9	81	20	10	9	0	0	0	0	0	0	0	0	0
FACTORS		LOSS		GAIN		LOSS		GAIN		LOSS		GAIN		LOSS		GAIN		LOSS	
GRS.WALL AREA		126		54		81		200		0		0		0		0		0	
GLAZING		LOSS		GAIN		LOSS		GAIN		LOSS		GAIN		LOSS		GAIN		LOSS	
NORTH	21.8	16.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
EAST	21.8	41.6	0	0	0	0	28	610	1163	36	784	1486	0	0	0	0	0	0	0
SOUTH	21.8	24.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
WEST	21.8	41.6	28	610	1163	8	174	332	0	0	0	0	0	0	0	0	0	0	0
SKYLT.	35.8	101.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
DOORS	25.8	4.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
NET EXPOSED WALL		4.2	0.7	98	412	68	46	193	32	53	223	37	164	690	113	0	0	0	0
SLAB ON GRADE HEAT LOSS		3.7	0.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
EXPOSED CLG		1.3	0.6	332	436	195	108	142	63	121	159	71	262	344	164	98	129	58	0
NO ATTIC EXPOSED CLG		2.8	1.3	0	0	0	0	0	0	0	0	0	38	107	48	0	0	0	0
EXPOSED FLOOR		2.6	0.4	0	0	0	0	0	0	121	316	52	29	76	12	98	256	42	0
BASEMENT/CRAWL HEAT LOSS		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
SLAB ON GRADE HEAT LOSS		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
SUBTOTAL HT LOSS		1458		510		1308		2001		385		100							
SUB TOTAL HT GAIN		0.20		0.27		0.20		0.27		0.20		0.27		0.20		0.27		100	
LEVEL FACTOR / MULTIPLIER		394		138		354		541		104		6							
AIR CHANGE HEAT LOSS		0		0		166		254		49		11							
AIR CHANGE HEAT GAIN		0		0		1		240		0		0							
DUCT GAIN		0		0		0		0		0		0							
HEAT GAIN PEOPLE		240		2	480	0	0	253	306				11						
HEAT GAIN APPLIANCES/LIGHTS					894			894	894				0						
TOTAL HT LOSS BTU/H		1853		647		1827		2796		537		150							
TOTAL HT GAIN x 1.3 BTU/H		3743		587		3618		4373		150									

ROOM USE		EXP. WALL		CLG. HT.		FACTORS		K/B/G		FOY		MUD		BAS	
EXP. WALL	CLG. HT.	20	26	10	11	12	289	242	20	26	11	12	20	26	67
FACTORS		LOSS		GAIN		LOSS		GAIN		LOSS		GAIN		LOSS	
GRS.WALL AREA		202		202		202		202		289		242		469	
GLAZING		LOSS		GAIN		LOSS		GAIN		LOSS		GAIN		LOSS	
NORTH	21.8	16.0	0	0	0	0	0	0	0	0	0	0	0	0	0
EAST	21.8	41.6	0	0	0	0	27	588	1122	0	0	0	0	0	0
SOUTH	21.8	24.9	0	0	0	0	0	0	0	0	0	0	0	0	0
WEST	21.8	41.6	78	1699	3241	0	0	0	0	0	0	0	0	12	261
SKYLT.	35.8	101.2	0	0	0	0	0	0	0	0	0	0	0	499	0
DOORS	25.8	4.3	0	0	0	0	0	0	0	0	0	0	0	0	0
NET EXPOSED WALL		4.2	0.7	124	521	86	40	1034	170	20	517	85	30	775	128
SLAB ON GRADE HEAT LOSS		3.7	0.6	0	0	0	222	932	153	222	934	154	0	0	0
EXPOSED CLG		1.3	0.6	0	0	0	0	0	0	0	0	0	201	740	122
EXPOSED FLOOR		2.8	1.3	0	0	0	0	0	0	0	0	0	0	0	0
BASEMENT/CRAWL HEAT LOSS		2.6	0.4	0	0	0	0	0	0	0	0	0	0	0	0
SLAB ON GRADE HEAT LOSS		0	0	0	0	0	0	0	0	0	0	0	0	0	0
SUBTOTAL HT LOSS		2221		3327		2554		1445		239		3920		748	
SUB TOTAL HT GAIN		0.30		0.37		0.30		0.37		0.30		0.37		0.50	
LEVEL FACTOR / MULTIPLIER		819		184		942		80		13		3826		41	
AIR CHANGE HEAT LOSS		0		0		0		0		0		0		0	
AIR CHANGE HEAT GAIN		0		0		0		0		0		0		0	
DUCT LOSS		0		0		0		0		0		0		0	
DUCT GAIN		0		0		0		0		0		0		0	
HEAT GAIN PEOPLE		240		0	480	0	253	306		0	0	0	0	0	0
HEAT GAIN APPLIANCES/LIGHTS				0	894			894		0	0	0	0	0	0
TOTAL HT LOSS BTU/H		3039		5726		1985		1583		327		7746		2188	

SITE NAME: CENTREFIELD (WEST GORMLEY)
BUILDER: ROYAL PINE HOMES

TYPE: 2008 DATE: Apr-21 GFA: 1672 LO# 87528

HEATING CFM	820	COOLING CFM	820
TOTAL HEAT LOSS	23,927	TOTAL HEAT GAIN	22,695
AIR FLOW RATE CFM	34,27	AIR FLOW RATE CFM	36,13

furnace pressure 0.6
furnace filter 0.05
a/c coil pressure 0.2
available pressure for s/a & r/a 0.35
plenum pressure s/a 0.18
max s/a dif press. loss 0.02
min adjusted pressure s/a 0.16

****CARRIER**
59TN6A-060-14V
FAN SPEED 60
AFUE = 97 %
INPUT (BTU/H) = 60,000
OUTPUT (BTU/H) = 58,000
DESIGN CFM = 820
CFM @ .6" E.S.P.

RUN COUNT	4th	3rd	2nd	1st	Bas
S/A	0	0	8	5	3
R/A	0	0	4	1	1

All S/A diffusers 4"x10" unless noted otherwise on layout.
All R/A runs 5"Ø unless noted otherwise on layout.

RUN #	1	2	3	4	5	6	7	10	14	15	18	19	20	21	23	24
ROOM NAME	MBR	MBR	BED-2	BED-2	BED-3	BED-3	BATH	ENS	K/B/G	K/B/G	FOY	FOY	MUD	BAS	BAS	BAS
RM LOSS MBH	0.93	0.93	0.91	0.91	1.40	1.40	0.54	0.65	1.52	1.52	1.75	1.75	1.99	2.58	2.58	2.58
CFM PER RUN HEAT	32	32	31	31	48	48	18	22	52	52	60	60	68	88	88	88
RM GAIN MBH	1.87	1.87	1.81	1.81	2.19	2.19	0.15	0.59	2.86	2.86	0.99	0.99	0.33	0.73	0.73	0.73
CFM PER RUN COOLING	68	68	65	65	79	79	5	21	103	103	36	36	12	26	26	26
ADJUSTED PRESSURE	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.16	0.16	0.17	0.17	0.17	0.16	0.16	0.16
ACTUAL DUCT LGH.	35	27	64	63	76	72	51	29	8	7	56	62	40	12	26	57
EQUIVALENT LENGTH	140	130	150	140	190	210	190	170	110	180	130	130	150	130	120	140
TOTAL EFFECTIVE LENGTH	175	157	214	203	266	282	241	199	118	187	186	192	190	142	146	197
ADJUSTED PRESSURE	0.1	0.11	0.08	0.08	0.06	0.06	0.07	0.09	0.14	0.09	0.09	0.09	0.09	0.11	0.11	0.08
ROUND DUCT SIZE	5	5	5	5	6	6	4	4	6	6	5	5	5	6	6	6
HEATING VELOCITY (ft/min)	235	235	228	228	245	245	207	252	265	265	441	441	449	449	449	449
COOLING VELOCITY (ft/min)	499	499	477	477	403	403	57	241	525	525	264	264	88	133	133	133
OUTLET GRILL SIZE	3X10	3X10	3X10	3X10	4X10	4X10	3X10	3X10	4X10	4X10	3X10	3X10	3X10	4X10	4X10	4X10
TRUNK	C	C	B	B	A	A	B	C	C	C	A	A	B	C	C	A

RUN #	1	2	3	4	5	6	7	10	14	15	18	19	20	21	23	24
ROOM NAME	MBR	MBR	BED-2	BED-2	BED-3	BED-3	BATH	ENS	K/B/G	K/B/G	FOY	FOY	MUD	BAS	BAS	BAS
RM LOSS MBH	0.93	0.93	0.91	0.91	1.40	1.40	0.54	0.65	1.52	1.52	1.75	1.75	1.99	2.58	2.58	2.58
CFM PER RUN HEAT	32	32	31	31	48	48	18	22	52	52	60	60	68	88	88	88
RM GAIN MBH	1.87	1.87	1.81	1.81	2.19	2.19	0.15	0.59	2.86	2.86	0.99	0.99	0.33	0.73	0.73	0.73
CFM PER RUN COOLING	68	68	65	65	79	79	5	21	103	103	36	36	12	26	26	26
ADJUSTED PRESSURE	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.16	0.16	0.17	0.17	0.17	0.16	0.16	0.16
ACTUAL DUCT LGH.	35	27	64	63	76	72	51	29	8	7	56	62	40	12	26	57
EQUIVALENT LENGTH	140	130	150	140	190	210	190	170	110	180	130	130	150	130	120	140
TOTAL EFFECTIVE LENGTH	175	157	214	203	266	282	241	199	118	187	186	192	190	142	146	197
ADJUSTED PRESSURE	0.1	0.11	0.08	0.08	0.06	0.06	0.07	0.09	0.14	0.09	0.09	0.09	0.09	0.11	0.11	0.08
ROUND DUCT SIZE	5	5	5	5	6	6	4	4	6	6	5	5	5	6	6	6
HEATING VELOCITY (ft/min)	235	235	228	228	245	245	207	252	265	265	441	441	449	449	449	449
COOLING VELOCITY (ft/min)	499	499	477	477	403	403	57	241	525	525	264	264	88	133	133	133
OUTLET GRILL SIZE	3X10	3X10	3X10	3X10	4X10	4X10	3X10	3X10	4X10	4X10	3X10	3X10	3X10	4X10	4X10	4X10
TRUNK	C	C	B	B	A	A	B	C	C	C	A	A	B	C	C	A

SUPPLY AIR TRUNK SIZE										RETURN AIR TRUNK SIZE									
	TRUNK CFM	STATIC PRESS.	ROUND DUCT	RECT DUCT	VELOCITY (ft/min)	TRUNK CFM	STATIC PRESS.	ROUND DUCT	RECT DUCT	VELOCITY (ft/min)	TRUNK CFM	STATIC PRESS.	ROUND DUCT	RECT DUCT	VELOCITY (ft/min)				
TRUNK A	304	0.06	9.6	10	8	TRUNK G	0	0.00	0	8	TRUNK O	0	0.05	0	8				
TRUNK B	452	0.06	11.2	14	8	TRUNK H	0	0.00	0	8	TRUNK P	0	0.05	0	8				
TRUNK C	820	0.06	14	22	8	TRUNK I	0	0.00	0	8	TRUNK Q	0	0.05	0	8				
TRUNK D	0	0.00	0	0	8	TRUNK J	0	0.00	0	8	TRUNK R	0	0.05	0	8				
TRUNK E	0	0.00	0	0	8	TRUNK K	0	0.00	0	8	TRUNK S	0	0.05	0	8				
TRUNK F	0	0.00	0	0	8	TRUNK L	0	0.00	0	8	TRUNK T	0	0.05	0	8				
											TRUNK U	0	0.05	0	8				
											TRUNK V	0	0.05	0	8				
											TRUNK W	0	0.05	0	8				
RETURN AIR #	1	2	3	4	5					BR	TRUNK X	820	0.05	14.6	8				
AIR VOLUME	95	115	75	75	340	0	0	0	0	0	TRUNK Y	360	0.05	10.8	24				
PLENUM PRESSURE	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	TRUNK Z	820	0.05	14.6	8				
ACTUAL DUCT LGH.	69	64	72	76	21	1	1	1	1	24	DROP			24	10				
EQUIVALENT LENGTH	215	255	225	230	175	0	0	0	0	145									
TOTAL EFFECTIVE LH	284	319	297	306	196	1	1	1	1	169									
ADJUSTED PRESSURE	0.05	0.05	0.05	0.05	0.08	14.80	14.80	14.80	14.80	14.80									
ROUND DUCT SIZE	6.5	7	6	6	9.4	0	0	0	0	0.09									
INLET GRILL SIZE	X	X	X	X	X	X	X	X	X	6.2									
INLET GRILL SIZE	14	14	14	14	30	0	0	0	0	8									

TYPE: 2008
SITE NAME: CENTREFIELD (WEST GORMLEY)

LO # 87528

RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY

COMBUSTION APPLIANCES		9.32.3.1(1)
a)	☒ Direct vent (sealed combustion) only	
b)	☐ Positive venting induced draft (except fireplaces)	
c)	☐ Natural draft, B-vent or induced draft gas fireplace	
d)	☐ Solid Fuel (including fireplaces)	
e)	☐ No Combustion Appliances	

HEATING SYSTEM	
☒ Forced Air	☐ Non Forced Air
☐ Electric Space Heat	

HOUSE TYPE		9.32.1(2)
☒ I	Type a) or b) appliance only, no solid fuel	
☐ II	Type I except with solid fuel (including fireplaces)	
☐ III	Any Type c) appliance	
☐ IV	Type I, or II with electric space heat	
☐	Other: Type I, II or IV no forced air	

SYSTEM DESIGN OPTIONS		O.N.H.W.P.
☐ 1	Exhaust only/Forced Air System	
☐ 2	HRV with Ducting/Forced Air System	
☒ 3	HRV Simplified/connected to forced air system	
☐ 4	HRV with Ducting/non forced air system	
☐	Part 6 Design	

TOTAL VENTILATION CAPACITY		9.32.3.3(1)
Basement + Master Bedroom	2 @ 21.2 cfm	42.4 cfm
Other Bedrooms	2 @ 10.6 cfm	21.2 cfm
Kitchen & Bathrooms	4 @ 10.6 cfm	42.4 cfm
Other Rooms	2 @ 10.6 cfm	21.2 cfm
Table 9.32.3.A.	TOTAL	127.2 cfm

PRINCIPAL VENTILATION CAPACITY REQUIRED		9.32.3.4.(1)
1	Bedroom	31.8 cfm
2	Bedroom	47.7 cfm
3	Bedroom	63.6 cfm
4	Bedroom	79.5 cfm
5	Bedroom	95.4 cfm
TOTAL		63.6 cfm

SUPPLEMENTAL VENTILATION CAPACITY		9.32.3.5.
Total Ventilation Capacity	127.2	cfm
Less Principal Ventil. Capacity	63.6	cfm
Required Supplemental Capacity	63.6	cfm

PRINCIPAL EXHAUST FAN CAPACITY	
Model:	VANEE 65H
Location:	BSMT
63.6 cfm	☒ HVI Approved

PRINCIPAL EXHAUST HEAT LOSS CALCULATION				
CFM	ΔT °F	FACTOR	% LOSS	
63.6 CFM	X 78 F	X 1.08	X	0.25

SUPPLEMENTAL FANS BY INSTALLING CONTRACTOR				
Location	Model	cfm	HVI	Sones
ENS	BY INSTALLING CONTRACTOR	50	☒	3.5
BATH	BY INSTALLING CONTRACTOR	50	☒	3.5
PWD	BY INSTALLING CONTRACTOR	50	☒	3.5

HEAT RECOVERY VENTILATOR		9.32.3.11.
Model:	VANEE 65H	
155	cfm high	64 cfm low
75	% Sensible Efficiency @ 32 deg F (0 deg C)	☒ HVI Approved

LOCATION OF INSTALLATION	
Lot:	Concession
Township	Plan:
Address	
Roll #	Building Permit #

BUILDER:	
ROYAL PINE HOMES	
Name:	
Address:	
City:	
Telephone #:	Fax #:

INSTALLING CONTRACTOR	
Name:	
Address:	
City:	
Telephone #:	Fax #:

DESIGNER CERTIFICATION	
I hereby certify that this ventilation system has been designed in accordance with the Ontario Building Code.	
Name:	HVAC Designs Ltd.
Signature:	<i>Michael O'Rourke</i>
HRAI #	001820
Date:	April-21

CSA F280-12 Residential Heat Loss and Heat Gain Calculations																																																																							
Formula Sheet (For Air Leakage / Ventilation Calculation)																																																																							
LO#: 87528	Model: 2008	Builder: ROYAL PINE HOMES	Date: 4/21/2021																																																																				
Volume Calculation		Air Change & Delta T Data																																																																					
<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th>House Volume</th> <th>Floor Area (ft²)</th> <th>Floor Height (ft)</th> <th>Volume (ft³)</th> </tr> <tr> <td>Level</td> <td></td> <td></td> <td></td> </tr> <tr> <td>Bsmt</td> <td>728</td> <td>10</td> <td>7280</td> </tr> <tr> <td>First</td> <td>728</td> <td>10</td> <td>7352.8</td> </tr> <tr> <td>Second</td> <td>959</td> <td>9</td> <td>8631</td> </tr> <tr> <td>Third</td> <td>0</td> <td>9</td> <td>0</td> </tr> <tr> <td>Fourth</td> <td>0</td> <td>9</td> <td>0</td> </tr> <tr> <td>Total:</td> <td></td> <td></td> <td>23,263.8 ft³</td> </tr> <tr> <td></td> <td></td> <td></td> <td>658.8 m³</td> </tr> </table>		House Volume	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)	Level				Bsmt	728	10	7280	First	728	10	7352.8	Second	959	9	8631	Third	0	9	0	Fourth	0	9	0	Total:			23,263.8 ft³				658.8 m³	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td>WINTER NATURAL AIR CHANGE RATE</td> <td>0.236</td> </tr> <tr> <td>SUMMER NATURAL AIR CHANGE RATE</td> <td>0.072</td> </tr> </table> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th colspan="4">Design Temperature Difference</th> </tr> <tr> <td></td> <td>Tin °C</td> <td>Tout °C</td> <td>ΔT °C</td> </tr> <tr> <td>Winter DTDh</td> <td>22</td> <td>-21</td> <td>43</td> </tr> <tr> <td>Summer DTDc</td> <td>24</td> <td>31</td> <td>7</td> </tr> <tr> <td></td> <td></td> <td></td> <td>ΔT °F</td> </tr> <tr> <td></td> <td></td> <td></td> <td>78</td> </tr> <tr> <td></td> <td></td> <td></td> <td>13</td> </tr> </table>		WINTER NATURAL AIR CHANGE RATE	0.236	SUMMER NATURAL AIR CHANGE RATE	0.072	Design Temperature Difference					Tin °C	Tout °C	ΔT °C	Winter DTDh	22	-21	43	Summer DTDc	24	31	7				ΔT °F				78				13
House Volume	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)																																																																				
Level																																																																							
Bsmt	728	10	7280																																																																				
First	728	10	7352.8																																																																				
Second	959	9	8631																																																																				
Third	0	9	0																																																																				
Fourth	0	9	0																																																																				
Total:			23,263.8 ft³																																																																				
			658.8 m³																																																																				
WINTER NATURAL AIR CHANGE RATE	0.236																																																																						
SUMMER NATURAL AIR CHANGE RATE	0.072																																																																						
Design Temperature Difference																																																																							
	Tin °C	Tout °C	ΔT °C																																																																				
Winter DTDh	22	-21	43																																																																				
Summer DTDc	24	31	7																																																																				
			ΔT °F																																																																				
			78																																																																				
			13																																																																				
6.2.6 Sensible Gain due to Air Leakage																																																																							
$HG_{satb} = LR_{airc} \times \frac{V_b}{3.6} \times DTD_c \times 1.2$ $= 0.072 \times 182.99 \times 7 \times 1.2 = 112 \text{ W}$ $= 382 \text{ Btu/h}$																																																																							
6.2.7 Sensible heat Gain due to Ventilation																																																																							
$HL_{yairb} = PVC \times DTD_h \times 1.08 \times (1 - E)$ $64 \text{ CFM} \times 13 \text{ °F} \times 1.08 \times 0.25 = 220 \text{ Btu/h}$																																																																							
5.2.3.3 Calculation of Air Change Heat Loss for Each Room (Floor Multiplier Section)																																																																							
$HL_{airrr} = \text{Level Factor} \times HL_{airbv} \times \{(HL_{agcr} + HL_{bgcr}) \div (HL_{agclevel} + HL_{bgclevel})\}$ <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th>Level</th> <th>Level Factor (LF)</th> <th>HLairbv Air Leakage + Ventilation Heat Loss (Btu/h)</th> <th>Level Conductive Heat Loss: (HL_{level})</th> <th>Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)</th> </tr> <tr> <td>1</td> <td>0.5</td> <td rowspan="4" style="text-align: center; vertical-align: middle;">7,651</td> <td>3,920</td> <td>0.976</td> </tr> <tr> <td>2</td> <td>0.3</td> <td>6,225</td> <td>0.369</td> </tr> <tr> <td>3</td> <td>0.2</td> <td>5,661</td> <td>0.270</td> </tr> <tr> <td>4</td> <td>0</td> <td>0</td> <td>0.000</td> </tr> <tr> <td>5</td> <td>0</td> <td></td> <td>0</td> <td>0.000</td> </tr> </table> *HLairbv = Air leakage heat loss + ventilation heat loss *For a balanced or supply only ventilation system HLairve = 0				Level	Level Factor (LF)	HLairbv Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{level})	Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)	1	0.5	7,651	3,920	0.976	2	0.3	6,225	0.369	3	0.2	5,661	0.270	4	0	0	0.000	5	0		0	0.000																																									
Level	Level Factor (LF)	HLairbv Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{level})	Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)																																																																			
1	0.5	7,651	3,920	0.976																																																																			
2	0.3		6,225	0.369																																																																			
3	0.2		5,661	0.270																																																																			
4	0		0	0.000																																																																			
5	0		0	0.000																																																																			

HEAT LOSS AND GAIN SUMMARY SHEET**MODEL:** 2008**BUILDER:** ROYAL PINE HOMES**SFQT:** 1672**LO#** 87528**SITE:** CENTREFIELD (WEST GORMLEY)**DESIGN ASSUMPTIONS**

HEATING	°F	COOLING	°F
OUTDOOR DESIGN TEMP.	-6	OUTDOOR DESIGN TEMP.	88
INDOOR DESIGN TEMP.	72	INDOOR DESIGN TEMP. (MAX 75°F)	75

BUILDING DATA

ATTACHMENT:	ATTACHED	# OF STORIES (+BASEMENT):	3
FRONT FACES:	EAST	ASSUMED (Y/N):	Y
AIR CHANGES PER HOUR:	2.50	ASSUMED (Y/N):	Y
AIR TIGHTNESS CATEGORY:	TIGHT	ASSUMED (Y/N):	Y
WIND EXPOSURE:	SHELTERED	ASSUMED (Y/N):	Y
HOUSE VOLUME (ft³):	23263.8	ASSUMED (Y/N):	Y
INTERNAL SHADING:	BLINDS/CURTAINS	ASSUMED OCCUPANTS:	4
INTERIOR LIGHTING LOAD (Btu/h/ft²):	1.85	DC BRUSHLESS MOTOR (Y/N):	Y
FOUNDATION CONFIGURATION	BCIN_1	DEPTH BELOW GRADE:	7.0 ft
LENGTH: 52.0 ft	WIDTH: 20.0 ft	EXPOSED PERIMETER:	67.0 ft

2012 OBC - COMPLIANCE PACKAGE		
Component	Compliance Package SB-12 PERFORMANCE	
	Nominal	Min. Eff.
Ceiling with Attic Space Minimum RSI (R)-Value	60	59.20
Ceiling Without Attic Space Minimum RSI (R)-Value	31	27.70
Exposed Floor Minimum RSI (R)-Value	31	29.80
Walls Above Grade Minimum RSI (R)-Value	22+1.5	18.50
Basement Walls Minimum RSI (R)-Value	20	21.12
Below Grade Slab Entire surface > 600 mm below grade Minimum RSI (R)-Value	-	-
Edge of Below Grade Slab ≤ 600 mm Below Grade Minimum RSI (R)-Value	10	10
Heated Slab or Slab ≤ 600 mm below grade Minimum RSI (R)-Value	10	11.13
Windows and Sliding Glass Doors Maximum U-Value	1.6	-
Skylights Maximum U-Value	2.6	-
Space Heating Equipment Minimum AFUE	0.96	-
HRV Minimum Efficiency	75%	-
Domestic Hot Water Heater Minimum EF	TE=94%	-


INDIVIDUAL BCIN: 19669

MICHAEL O'ROURKE



Residential Foundation Thermal Load Calculator

Supplemental tool for CAN/CSA-F280

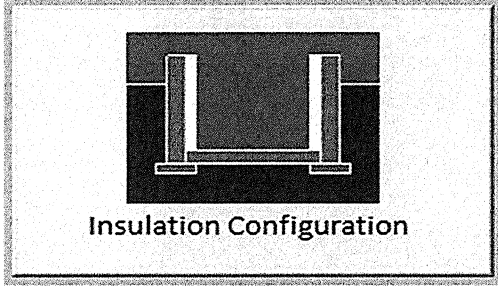
Weather Station Description		
Province:	Ontario	
Region:	Richmond Hill	
Site Description		
Soil Conductivity:	Normal conductivity: dry sand, loam, clay	
Water Table:	Normal (7-10 m, 23-33 ft)	
Foundation Dimensions		
Floor Length (m):	15.8	 Insulation Configuration
Floor Width (m):	6.1	
Exposed Perimeter (m):	20.4	
Wall Height (m):	3.0	
Depth Below Grade (m):	2.13	
Window Area (m ²):	1.1	
Door Area (m ²):	2.8	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	33	
Design Months		
Heating Month	1	
Foundation Loads		
Heating Load (Watts):		628

TYPE: 2008
LO# 87528


Air Infiltration Residential Load Calculator

Supplemental tool for CAN/CSA-F280

Weather Station Description				
Province:	Ontario			
Region:	Richmond Hill			
Weather Station Location:	Open flat terrain, grass			
Anemometer height (m):	10			
Local Shielding				
Building Site:	Suburban, forest			
Walls:	Heavy			
Flue:	Heavy			
Highest Ceiling Height (m):	6.74			
Building Configuration				
Type:	Semi			
Number of Stories:	Two			
Foundation:	Full			
House Volume (m ³):	658.8			
Air Leakage/Ventilation				
Air Tightness Type:	Energy Star Detached (2.5 ACH)			
Custom BDT Data:	ELA @ 10 Pa.	614.9 cm ²		
	2.50	ACH @ 50 Pa		
Mechanical Ventilation (L/s):	Total Supply	Total Exhaust		
	30.0	30.0		
Flue Size				
Flue #:	#1	#2	#3	#4
Diameter (mm):	0	0	0	0
Natural Infiltration Rates				
Heating Air Leakage Rate (ACH/H):	0.236			
Cooling Air Leakage Rate (ACH/H):	0.072			

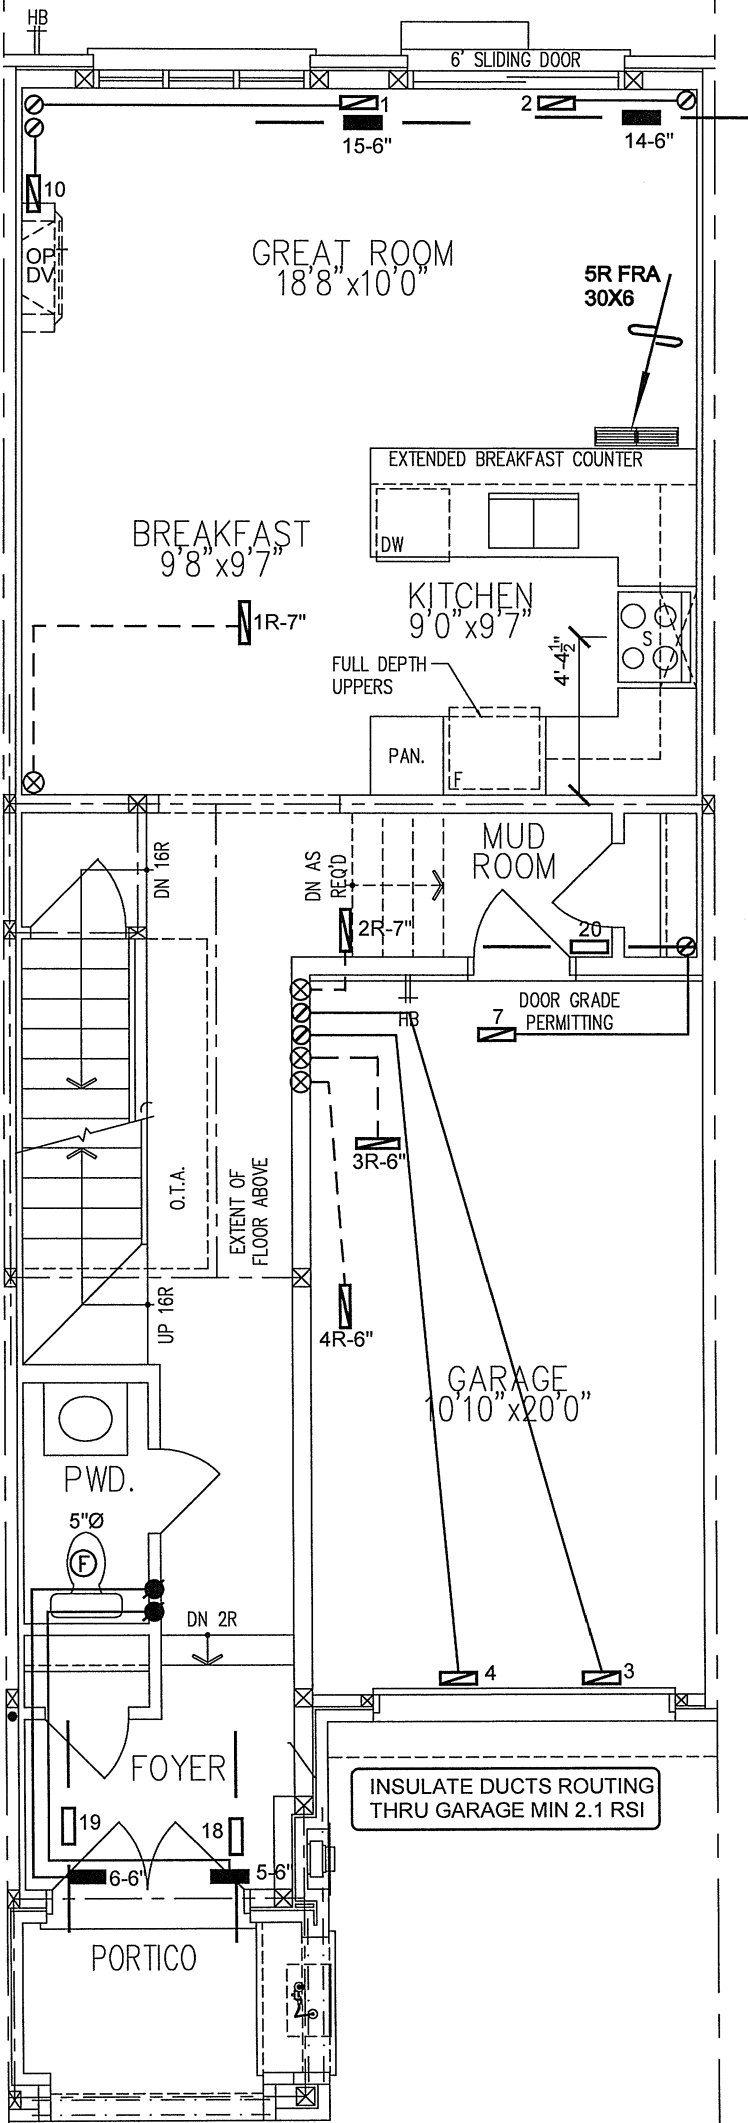

GROUND FLOOR PLAN, EL. 'A'

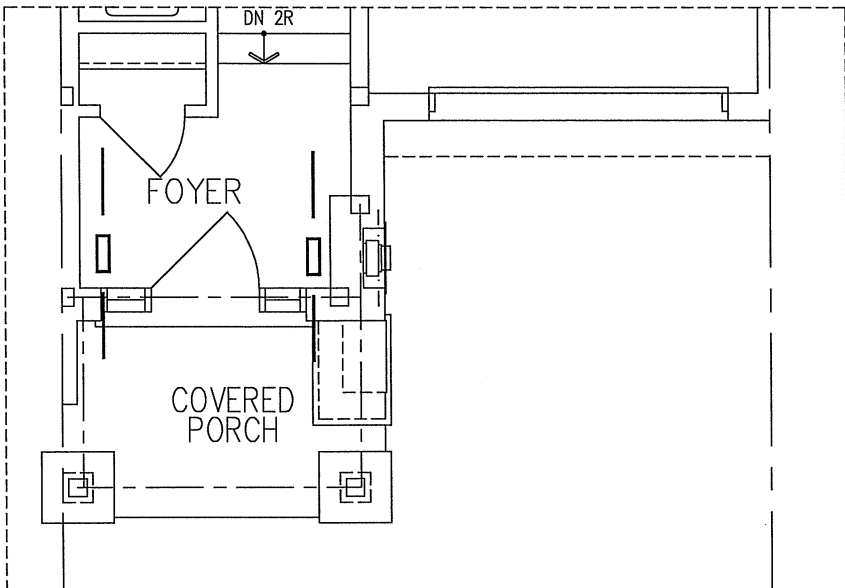

GROUND FLOOR PLAN, EL. 'B'

I MICHAEL O'ROURKE HAVE REVIEWED AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C, 3.2.5 OF THE BUILDING CODE.
Michael O'Rourke
Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.


CSA-F280-12

SB-12 PERFORMANCE


HVAC LEGEND								3.		
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.	REVISED AS PER ARCHITECTURALS	APR/2021
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.	REVISED TO PERFORMANCE	SEPT/2020
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description	Date
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	REVISIONS		

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client		HVACDESIGNS LTD. 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdesigns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.	Sheet Title	
ROYAL PINE HOMES			FIRST FLOOR HEATING LAYOUT	
Project Name			Date	SEPT/2020
CENTREFIELD (WEST GORMLEY) RICHMOND HILL, ONTARIO			Scale	3/16" = 1'-0"
			BCIN# 19669	
2008	1672 sqft	LO# 87528		

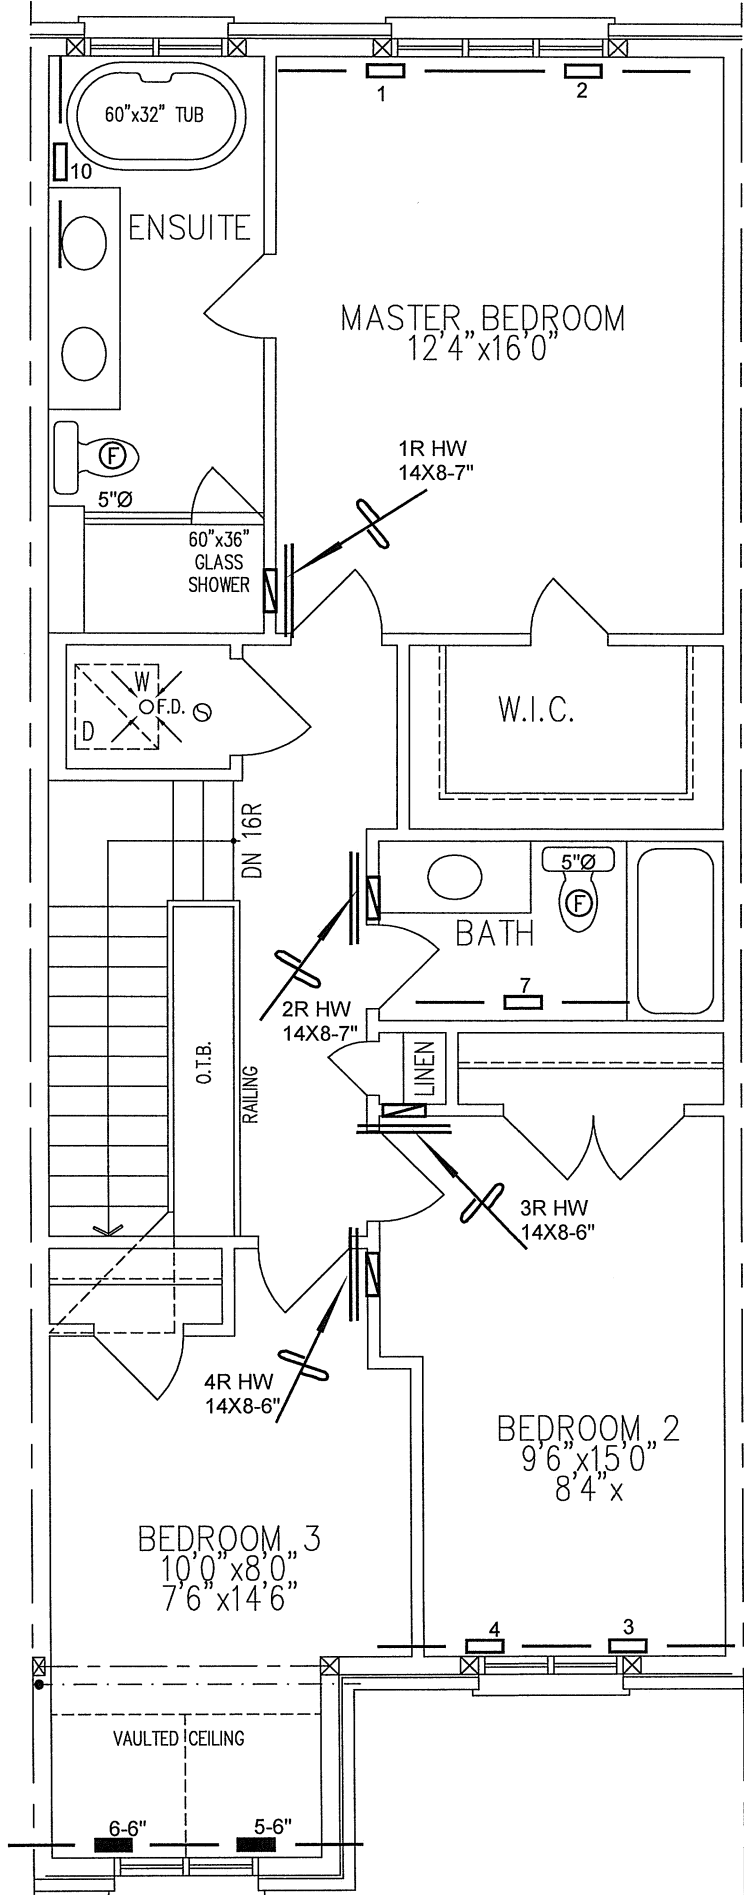

SECOND FLOOR PLAN,
EL. 'A1/A2'

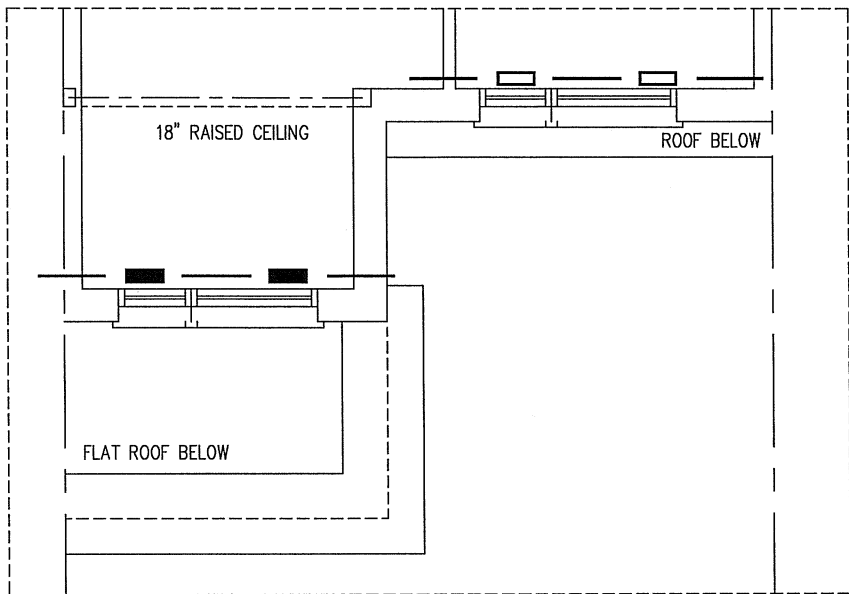

SECOND FLOOR PLAN, EL. 'B'

I MICHAEL O'ROURKE HAVE REVIEW
AND TAKE RESPONSIBILITY FOR THE
DESIGN WORK AND AM QUALIFIED
UNDER DIVISION C, 3.2.3 OF THE
BUILDING CODE.
Michael O'Rourke
Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.

CSA-F280-12

SB-12 PERFORMANCE

HVAC LEGEND								3.		
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.	REVISED AS PER ARCHITECTURALS	APR/2021
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.	REVISED TO PERFORMANCE	SEPT/2020
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description	Date
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	REVISIONS		

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client		 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdesigns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services	Sheet Title	
ROYAL PINE HOMES			SECOND FLOOR HEATING LAYOUT	
Project Name CENTREFIELD (WEST GORMLEY) RICHMOND HILL, ONTARIO			Date	SEPT/2020
		Scale	3/16" = 1'-0"	
		BCIN# 19669		
2008		LO# 87528		
1672 sqft				