

Schedule 1: Designer Information

Use one form for each individual who reviews and takes responsibility for design activities with respect to the project.

A. Project Information			
Building number, street name		Unit no.	Lot/con.
Municipality RICHMOND HILL	Postal code	Plan number/ other description	
B. Individual who reviews and takes responsibility for design activities			
Name MICHAEL O'ROURKE		Firm HVAC DESIGNS LTD.	
Street address 375 FINLEY AVE		Unit no. 202	Lot/con. N/A
Municipality AJAX	Postal code L1S 2E2	Province ONTARIO	E-mail info@hvacdesigns.ca
Telephone number (905) 619-2300	Fax number (905) 619-2375	Cell number ()	
C. Design activities undertaken by individual identified in Section B. [Building Code Table 3.5.2.1 OF Division C]			
☐ House ☐ Small Buildings ☐ Large Buildings ☐ Complex Buildings ☒ HVAC – House ☐ Building Services ☐ Detection, Lighting and Power ☐ Fire Protection ☐ Building Structural ☐ Plumbing – House ☐ Plumbing – All Buildings ☐ On-site Sewage Systems			
Description of designer's work HEAT LOSS / GAIN CALCULATIONS DUCT SIZING RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY RESIDENTIAL SYSTEM DESIGN per CSA-F280-12		Model: 4504 FLANKAGE OPT. 2ND Project: CENTREFIELD (WEST GORMLEY)	
D. Declaration of Designer			
I, <u>MICHAEL O'ROURKE</u> declare that (choose one as appropriate): (print name)			
☐ I review and take responsibility for the design work on behalf of a firm registered under subsection 3.2.4. of Division C, of the Building Code. I am qualified, and the firm is registered, in the appropriate classes/categories. Individual BCIN: _____ Firm BCIN: _____			
☒ I review and take responsibility for the design and am qualified in the appropriate category as an "other designer" under subsection 3.2.5. of Division C, of the Building Code. Individual BCIN: <u>19669</u> Basis for exemption from registration and qualification: <u>O.B.C SENTENCE 3.2.4.1 (4)</u>			
☐ The design work is exempt from the registration and qualification requirements of the Building Code. Basis for exemption from registration and qualification: _____			
I certify that:			
1. The information contained in this schedule is true to the best of my knowledge. 2. I have submitted this application with the knowledge and consent of the firm.			
June 7, 2021			
Date		Signature of Designer	

NOTE:

- For the purposes of this form, "individual" means the "person" referred to in Clause 3.2.4.7(1) d) of Division C, Article 3.2.5.1. of Division C, and all other persons who are exempt from qualification under Subsections 3.2.4. and 3.2.5. of Division C.
- Schedule 1 is not required to be completed by a holder of a license, temporary license, or a certificate of authorization, issued by the Ontario Association of Architects. Schedule 1 is also not required to be completed by a holder of a license to practise, a limited license to practise, or a certificate of authorization, issued by the Association of Professional Engineers of Ontario.

Application for a Permit Construct or Demolish – Effective January 1, 2015

SITE NAME: CENTREFIELD (WEST GORMLEY)				OPT. 2ND				DATE: Jun-21				WINTER NATURAL AIR CHANGE RATE 0.219				HEAT LOSS ΔT °F. 78				CSA-F280-12							
BUILDER: ROYAL PINE HOMES				TYPE: 4504 FLANKAGE				GFA: 3309				LO# 87518				SUMMER NATURAL AIR CHANGE RATE 0.068				HEAT GAIN ΔT °F. 13				SB-12 PERFORMANCE			
ROOM USE				MBR		ENS		WIC		BED-2		BED-3		BED-4		ENS-4/5		BED-5				ENS-2/3					
EXP. WALL				33		8		5		37		13		45		23		15				7					
CLG. HT.				8		8		8		8		8		8		8		8				8					
FACTORS																											
GRS.WALL AREA		LOSS GAIN		264		64		40		296		104		360		184		120				56					
GLAZING				LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN				LOSS GAIN					
NORTH		21.8	16.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
EAST		21.8	41.6	0	0	0	0	0	0	0	0	0	36	784	1496	49	1067	2036	0	0	0	0	0	0	0		
SOUTH		21.8	24.9	19	414	473	19	414	473	0	0	0	0	0	0	19	414	473	24	523	598	0	0	0	0		
WEST		21.8	41.6	36	784	1496	0	0	0	0	0	0	28	610	1163	0	0	0	0	0	0	0	0	0	0		
SKYLT.		35.8	101.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
DOORS		25.8	4.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
NET EXPOSED WALL		4.2	0.7	209	879	145	45	189	31	40	168	28	268	1127	185	68	286	47	292	1228	202	160	673	111	120	505	83
NET EXPOSED BSMT WALL ABOVE GR		3.7	0.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
EXPOSED CLG		1.3	0.6	289	380	170	141	185	83	70	92	41	297	390	175	190	250	112	252	331	148	90	118	53	247	325	145
NO ATTIC EXPOSED CLG		2.8	1.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
EXPOSED FLOOR		2.6	0.4	0	0	0	0	0	0	0	0	0	0	0	0	190	496	82	0	0	0	0	0	0	0	0	
BASEMENT/CRAWL HEAT LOSS				0		0		0		0		0		0		0		0		0		0		0		0	
SLAB ON GRADE HEAT LOSS				0		0		0		0		0		0		0		0		0		0		0		0	
SUBTOTAL HT LOSS				2457		788		260		2127		1816		3040		1314		829				992					
SUB TOTAL HT GAIN						2283		587		69		1523		1736		2859		761		228				888			
LEVEL FACTOR / MULTIPLIER		0.20 0.19				0.20 0.19				0.20 0.19				0.20 0.19		0.20 0.19		0.20 0.19		0.20 0.19				0.20 0.19			
AIR CHANGE HEAT LOSS				463		148		49		401		342		573		247		156				187					
AIR CHANGE HEAT GAIN				99		25		3		66		75		124		33		10				39					
DUCT LOSS				0		0		0		0		216		0		0		0				118					
DUCT GAIN				0		0		0		0		266		0		0		0				93					
HEAT GAIN PEOPLE		240		2	480	0	0	0	0	1	240	1	240	1	240	0	0	1	240	0	1	240	0	0	0	0	0
HEAT GAIN APPLIANCES/LIGHTS				610		0		0		610		610		610		610		610				610		0		0	
TOTAL HT LOSS BTU/H				2920		937		309		2528		2374		3613		1561		985				1296					
TOTAL HT GAIN x 1.3 BTU/H				4515		796		93		3172		3806		4984		1032		1415				1325					

ROOM USE		LIV	DIN	KT/GT	DEN	LAUN	W/R	FOY	MUD				BAS
EXP. WALL		25	28	64	23	0	6	23	22				170
CLG. HT.		10	10	10	10	8	10	10	11				9
FACTORS													
GRS.WALL AREA	LOSS GAIN	250	280	640	230	0	60	230	242				1020
GLAZING		LOSS GAIN	LOSS GAIN	LOSS GAIN	LOSS GAIN	LOSS GAIN	LOSS GAIN	LOSS GAIN	LOSS GAIN				LOSS GAIN
NORTH	21.8 16.0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0				4 87 64
EAST	21.8 41.6	37 806 1537	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	6 131 249	0 0 0				0 0 0
SOUTH	21.8 24.9	23 501 573	34 741 847	41 893 1021	0 0 0	0 0 0	9 196 224	0 0 0	0 0 0				8 174 199
WEST	21.8 41.6	0 0 0	0 0 0	103 2244 4280	23 501 956	0 0 0	0 0 0	0 0 0	0 0 0				8 174 332
SKYLT.	35.8 101.2	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0				0 0 0
DOORS	25.8 4.3	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	40 1034 170	20 517 85				20 517 85
NET EXPOSED WALL	4.2 0.7	190 799 131	246 1035 170	496 2086 343	207 871 143	0 0 0	51 214 35	184 774 127	222 934 154				0 0 0
NET EXPOSED BSMT WALL ABOVE GR	3.7 0.6	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0				510 1879 309
EXPOSED CLG	1.3 0.6	0 0 0	0 0 0	0 0 0	0 0 0	125 164 73	0 0 0	0 0 0	0 0 0				0 0 0
NO ATTIC EXPOSED CLG	2.8 1.3	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0				0 0 0
EXPOSED FLOOR	2.6 0.4	0 0 0	0 0 0	0 0 0	0 0 0	36 94 15	0 0 0	0 0 0	0 0 0				0 0 0
BASEMENT/CRAWL HEAT LOSS		0	0	0	0	0	0	0	0				5751
SLAB ON GRADE HEAT LOSS		0	0	0	0	0	0	0	0				
SUBTOTAL HT LOSS		2106	1775	5223	1372	258	411	1938	1451				8583
SUB TOTAL HT GAIN			2242	1017	5644	1099	89	259	547				990
LEVEL FACTOR / MULTIPLIER	0.30 0.27		0.30 0.27	0.30 0.27	0.30 0.27	0.20 0.19	0.30 0.27	0.30 0.27	0.30 0.27				0.50 0.76
AIR CHANGE HEAT LOSS		579	488	1435	377	49	113	532	398				6536
AIR CHANGE HEAT GAIN			97	44	245	48	4	11	24				43
DUCT LOSS		0	0	0	0	31	0	0	0				0
DUCT GAIN		0	0	0	0	0	0	0	0				0
HEAT GAIN PEOPLE	240	0	0	0	0	0	0	0	0				0
HEAT GAIN APPLIANCES/LIGHTS			610	610	610	610	610	0	0				0
TOTAL HT LOSS BTU/H		2685	2263	6658	1748	338	523	2471	1849				15119
TOTAL HT GAIN x 1.3 BTU/H			3834	2172	8449	2284	1005	352	324				1342

TOTAL HEAT GAIN BTU/H:

41971

TONS: 3.50

LOSS DUE TO VENTILATION LOAD BTU/H: 2004

STRUCTURAL HEAT LOSS: 50176

TOTAL COMBINED HEAT LOSS BTU/H: 52180

SITE NAME: CENTREFIELD (WEST GORMLEY)
BUILDER: ROYAL PINE HOMES

OPT. 2ND
TYPE: 4504 FLANKAGE

DATE: Jun-21

GFA: 3309 LO# 87518

HEATING CFM 1370 COOLING CFM 1370
TOTAL HEAT LOSS 50,176 TOTAL HEAT GAIN 41,642
AIR FLOW RATE CFM 27.3 AIR FLOW RATE CFM 32.9

furnace pressure 0.6
furnace filter 0.05
a/c coil pressure 0.2
available pressure
for s/a & r/a 0.35

**CARRIER
59TN6A-060-14V
FAN SPEED 60

AFUE = 97 %
INPUT (BTU/H) = 60,000
OUTPUT (BTU/H) = 58,000

RUN COUNT	4th	3rd	2nd	1st	Bas
S/A	0	0	14	10	5
R/A	0	0	5	3	1

plenium pressure s/a 0.18 r/a pressure 0.17
max s/a dif press. loss 0.02 r/a grille press. Loss 0.02
min unadjusted pressure s/a 0.16 adjusted pressure r/a 0.15

LOW 820
MEDLOW 0
MEDIUM 0
MEDIUM HIGH 1370
HIGH 1520

DESIGN CFM = 1370
CFM @ .6" E.S.P.

All S/A diffusers 4"x10" unless noted otherwise on layout.

All S/A runs 5"Ø unless noted otherwise on layout.

RUN #	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
ROOM NAME	MBR	WIC	MBR	BED-3	BED-4	BED-5	ENS-4/5	ENS-2/3	BED-4	BED-2	BED-3	LIV	LIV	KT/GT	KT/GT	KT/GT	LAUN	W/R	FOY	MUD	BAS	BAS	BAS	BAS
RM LOSS MBH.	1.46	0.31	1.46	1.19	1.81	0.99	1.56	1.30	1.81	1.26	1.19	1.34	1.34	2.22	2.22	2.22	0.34	0.52	2.47	1.85	3.02	3.02	3.02	3.02
CFM PER RUN HEAT	40	8	40	32	49	27	43	35	49	35	32	37	37	61	61	61	9	14	67	50	83	83	83	83
RM GAIN MBH.	2.26	0.09	2.26	1.90	2.49	1.41	1.03	1.33	2.49	1.59	1.90	1.92	1.92	2.82	2.82	2.82	1.01	0.35	0.74	0.32	0.27	0.27	0.27	0.27
CFM PER RUN COOLING	74	3	74	63	82	47	34	44	82	52	63	63	63	93	93	93	33	12	24	11	9	9	9	9
ADJUSTED PRESSURE	0.17	0.17	0.17	0.17	0.16	0.17	0.17	0.17	0.16	0.17	0.17	0.17	0.17	0.16	0.16	0.16	0.17	0.17	0.17	0.17	0.16	0.16	0.16	0.16
ACTUAL DUCT LGH.	53	57	64	39	61	59	47	46	57	61	43	54	48	40	35	44	31	43	35	41	36	46	21	40
EQUIVALENT LENGTH	180	200	150	180	180	200	190	200	150	220	190	140	170	170	130	160	190	120	160	160	90	100	130	110
TOTAL EFFECTIVE LENGTH	233	257	214	219	241	259	237	246	207	281	233	194	218	210	165	204	221	163	195	201	126	146	151	150
ADJUSTED PRESSURE	0.07	0.07	0.08	0.08	0.07	0.07	0.07	0.07	0.08	0.06	0.07	0.09	0.08	0.08	0.1	0.08	0.08	0.11	0.09	0.09	0.13	0.11	0.11	0.11
ROUND DUCT SIZE	6	4	6	5	6	6	5	5	6	5	5	5	5	6	6	6	4	4	5	5	6	6	6	6
HEATING VELOCITY (ft/min)	204	92	204	235	250	138	316	257	250	257	235	272	272	311	311	311	103	161	492	367	423	423	423	423
COOLING VELOCITY (ft/min)	377	34	377	463	418	240	250	323	418	382	463	463	463	474	474	474	379	138	176	81	46	46	46	46
OUTLET GRILL SIZE	4X10	3X10	4X10	3X10	4X10	4X10	3X10	3X10	4X10	3X10	3X10	3X10	3X10	4X10	4X10	4X10	3X10	3X10	3X10	3X10	4X10	4X10	4X10	4X10
TRUNK	C	C	C	B	A	B	B	B	A	C	B	A	A	C	C	C	B	B	A	D	D	D	D	B

RUN #	25	26	27	28	29
ROOM NAME	BAS	DIN	DEN	ENS	BED-2
RM LOSS MBH.	3.02	2.26	1.75	0.94	1.26
CFM PER RUN HEAT	83	62	48	26	35
RM GAIN MBH.	0.27	2.17	2.28	0.80	1.59
CFM PER RUN COOLING	9	71	75	26	52
ADJUSTED PRESSURE	0.16	0.17	0.17	0.17	0.17
ACTUAL DUCT LGH.	39	33	43	26	70
EQUIVALENT LENGTH	150	140	210	140	230
TOTAL EFFECTIVE LENGTH	189	173	253	166	300
ADJUSTED PRESSURE	0.09	0.1	0.07	0.1	0.06
ROUND DUCT SIZE	6	6	6	4	5
HEATING VELOCITY (ft/min)	423	316	245	298	257
COOLING VELOCITY (ft/min)	46	362	382	298	382
OUTLET GRILL SIZE	4X10	4X10	4X10	3X10	3X10
TRUNK	A	B	C	E	C

SUPPLY AIR TRUNK SIZE								RETURN AIR TRUNK SIZE							
TRUNK	STATIC	ROUND	RECT	VELOCITY				TRUNK	STATIC	ROUND	RECT	VELOCITY			
CFM	PRESS.	DUCT	DUCT	(ft/min)				CFM	PRESS.	DUCT	DUCT	(ft/min)			
TRUNK A	322	0.07	9.5	12	x	8	483	TRUNK G	0	0.00	0	0	x	8	0
TRUNK B	659	0.07	12.4	18	x	8	659	TRUNK H	0	0.00	0	0	x	8	0
TRUNK C	389	0.06	10.6	16	x	8	438	TRUNK I	0	0.00	0	0	x	8	0
TRUNK D	688	0.06	13.1	20	x	8	619	TRUNK J	0	0.00	0	0	x	8	0
TRUNK E	1370	0.06	17	26	x	10	759	TRUNK K	0	0.00	0	0	x	8	0
TRUNK F	0	0.00	0	0	x	8	0	TRUNK L	0	0.00	0	0	x	8	0

RETURN AIR #	1	2	3	4	5	6	7	8	BR							
AIR VOLUME	115	115	105	105	135	125	370	125	0	0	0	0	0	0	0	175
PLENUM PRESSURE	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15
ACTUAL DUCT LGH.	53	47	73	45	42	48	23	57	1	1	1	1	1	1	1	14
EQUIVALENT LENGTH	215	175	255	255	135	215	260	175	0	0	0	0	0	0	0	260
TOTAL EFFECTIVE LH	268	222	328	300	177	263	283	232	1	1	1	1	1	1	1	274
ADJUSTED PRESSURE	0.06	0.07	0.05	0.05	0.08	0.06	0.05	0.06	14.80	14.80	14.80	14.80	14.80	14.80	14.80	0.05
ROUND DUCT SIZE	6.7	6.5	6.8	6.8	6.6	6.9	10.9	6.9	0	0	0	0	0	0	0	8.2
INLET GRILL SIZE	8	8	8	8	8	8	8	8	0	0	0	0	0	0	0	8
	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
INLET GRILL SIZE	14	14	14	14	14	14	30	14	0	0	0	0	0	0	0	24

**CARRIER
59TN6A-060-14V
FAN SPEED 60
LOW 820
MEDLOW 0
MEDIUM 0
MEDIUM HIGH 1370
HIGH 1520

AFUE = 97 %
INPUT (BTU/H) = 60,000
OUTPUT (BTU/H) = 58,000
DESIGN CFM = 1370
CFM @ .6" E.S.P.
TEMPERATURE RISE 39 °F

TYPE: 4504 FLANKAGE
SITE NAME: CENTREFIELD (WEST GORMLEY)

LO # 87518
OPT. 2ND

RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY

COMBUSTION APPLIANCES		9.32.3.1(1)
a)	☒ Direct vent (sealed combustion) only	
b)	☐ Positive venting induced draft (except fireplaces)	
c)	☐ Natural draft, B-vent or induced draft gas fireplace	
d)	☐ Solid Fuel (including fireplaces)	
e)	☐ No Combustion Appliances	

HEATING SYSTEM	
☒ Forced Air	☐ Non Forced Air
☐ Electric Space Heat	

HOUSE TYPE		9.32.1(2)
☒ I	Type a) or b) appliance only, no solid fuel	
☐ II	Type I except with solid fuel (including fireplaces)	
☐ III	Any Type c) appliance	
☐ IV	Type I, or II with electric space heat	
☐	Other: Type I, II or IV no forced air	

SYSTEM DESIGN OPTIONS		O.N.H.W.P.
☐ 1	Exhaust only/Forced Air System	
☐ 2	HRV with Ducting/Forced Air System	
☒ 3	HRV Simplified/connected to forced air system	
☐ 4	HRV with Ducting/non forced air system	
☐	Part 6 Design	

TOTAL VENTILATION CAPACITY		9.32.3.3(1)
Basement + Master Bedroom	<u>2</u> @ 21.2 cfm	<u>42.4</u> cfm
Other Bedrooms	<u>4</u> @ 10.6 cfm	<u>42.4</u> cfm
Kitchen & Bathrooms	<u>5</u> @ 10.6 cfm	<u>53</u> cfm
Other Rooms	<u>6</u> @ 10.6 cfm	<u>63.6</u> cfm
Table 9.32.3.A.	TOTAL	<u>201.4</u> cfm

PRINCIPAL VENTILATION CAPACITY REQUIRED		9.32.3.4.(1)
1 Bedroom	31.8	cfm
2 Bedroom	47.7	cfm
3 Bedroom	63.6	cfm
4 Bedroom	79.5	cfm
5 Bedroom	95.4	cfm
TOTAL		<u>95.4</u> cfm

SUPPLEMENTAL VENTILATION CAPACITY		9.32.3.5.
Total Ventilation Capacity	<u>201.4</u>	cfm
Less Principal Ventil. Capacity	<u>95.4</u>	cfm
Required Supplemental Capacity	<u>106.0</u>	cfm

PRINCIPAL EXHAUST FAN CAPACITY	
Model:	VANEE 65H
Location:	BSMT
<u>95.4</u> cfm	☒ HVI Approved

PRINCIPAL EXHAUST HEAT LOSS CALCULATION				
CFM	ΔT °F	FACTOR	% LOSS	
95.4 CFM	X 78 F	X 1.08	X	0.25

SUPPLEMENTAL FANS		BY INSTALLING CONTRACTOR		
Location	Model	cfm	HVI	Sones
ENS	BY INSTALLING CONTRACTOR	50	☒	3.5
ENS-4/5	BY INSTALLING CONTRACTOR	50	☒	3.5
ENS-2/3	BY INSTALLING CONTRACTOR	50	☒	3.5
W/R	BY INSTALLING CONTRACTOR	50	☒	3.5

HEAT RECOVERY VENTILATOR		9.32.3.11.
Model:	VANEE 65H	
<u>155</u> cfm high	<u>64</u> cfm low	
<u>75</u> % Sensible Efficiency	☒ HVI Approved	
@ 32 deg F (0 deg C)		

LOCATION OF INSTALLATION	
Lot:	Concession
Township	Plan:
Address	
Roll #	Building Permit #

BUILDER:	
ROYAL PINE HOMES	
Name:	
Address:	
City:	
Telephone #:	Fax #:

INSTALLING CONTRACTOR	
Name:	
Address:	
City:	
Telephone #:	Fax #:

DESIGNER CERTIFICATION	
I hereby certify that this ventilation system has been designed in accordance with the Ontario Building Code.	
Name:	HVAC Designs Ltd.
Signature:	<i>Michael O'Rourke</i>
HRAI #	001820
Date:	June-21

I REVIEW AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED IN THE APPROPRIATE CATEGORY AS AN "OTHER DESIGNER" UNDER DIVISION C, 3.2.5 OF THE BUILDING CODE.
INDIVIDUAL BCIN: 19669 *Michael O'Rourke* MICHAEL O'ROURKE

CSA F280-12 Residential Heat Loss and Heat Gain Calculations																																																												
Formula Sheet (For Air Leakage / Ventilation Calculation)																																																												
LO#: 87518	Model: 4504 FLANKAGE	Builder: ROYAL PINE HOMES	Date: 6/7/2021																																																									
Volume Calculation			Air Change & Delta T Data																																																									
House Volume <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>Level</th> <th>Floor Area (ft²)</th> <th>Floor Height (ft)</th> <th>Volume (ft³)</th> </tr> </thead> <tbody> <tr> <td>Bsmt</td> <td>1496</td> <td>9</td> <td>13464</td> </tr> <tr> <td>First</td> <td>1496</td> <td>10</td> <td>14960</td> </tr> <tr> <td>Second</td> <td>1813</td> <td>8</td> <td>14504</td> </tr> <tr> <td>Third</td> <td>0</td> <td>9</td> <td>0</td> </tr> <tr> <td>Fourth</td> <td>0</td> <td>9</td> <td>0</td> </tr> <tr> <td colspan="3" style="text-align: right;">Total:</td> <td>42,928.0 ft³</td> </tr> <tr> <td colspan="3" style="text-align: right;">Total:</td> <td>1215.6 m³</td> </tr> </tbody> </table>			Level	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)	Bsmt	1496	9	13464	First	1496	10	14960	Second	1813	8	14504	Third	0	9	0	Fourth	0	9	0	Total:			42,928.0 ft³	Total:			1215.6 m³	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 80%;">WINTER NATURAL AIR CHANGE RATE</td> <td style="width: 20%; text-align: center;">0.219</td> </tr> <tr> <td>SUMMER NATURAL AIR CHANGE RATE</td> <td style="text-align: center;">0.068</td> </tr> </table> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th colspan="5" style="text-align: center;">Design Temperature Difference</th> </tr> <tr> <th></th> <th>Tin °C</th> <th>Tout °C</th> <th>ΔT °C</th> <th>ΔT °F</th> </tr> <tr> <td>Winter DTDh</td> <td style="text-align: center;">22</td> <td style="text-align: center;">-21</td> <td style="text-align: center;">43</td> <td style="text-align: center;">78</td> </tr> <tr> <td>Summer DTDc</td> <td style="text-align: center;">24</td> <td style="text-align: center;">31</td> <td style="text-align: center;">7</td> <td style="text-align: center;">13</td> </tr> </table>		WINTER NATURAL AIR CHANGE RATE	0.219	SUMMER NATURAL AIR CHANGE RATE	0.068	Design Temperature Difference						Tin °C	Tout °C	ΔT °C	ΔT °F	Winter DTDh	22	-21	43	78	Summer DTDc	24	31	7	13
Level	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)																																																									
Bsmt	1496	9	13464																																																									
First	1496	10	14960																																																									
Second	1813	8	14504																																																									
Third	0	9	0																																																									
Fourth	0	9	0																																																									
Total:			42,928.0 ft³																																																									
Total:			1215.6 m³																																																									
WINTER NATURAL AIR CHANGE RATE	0.219																																																											
SUMMER NATURAL AIR CHANGE RATE	0.068																																																											
Design Temperature Difference																																																												
	Tin °C	Tout °C	ΔT °C	ΔT °F																																																								
Winter DTDh	22	-21	43	78																																																								
Summer DTDc	24	31	7	13																																																								
5.2.3.1 Heat Loss due to Air Leakage			6.2.6 Sensible Gain due to Air Leakage																																																									
$HL_{airb} = LR_{airh} \times \frac{V_b}{3.6} \times DTD_h \times 1.2$ 0.219 x 337.66 x 43 °C x 1.2 = 3831 W = 13072 Btu/h			$HG_{salb} = LR_{airc} \times \frac{V_b}{3.6} \times DTD_c \times 1.2$ 0.068 x 337.66 x 7 °C x 1.2 = 196 W = 670 Btu/h																																																									
5.2.3.2 Heat Loss due to Mechanical Ventilation			6.2.7 Sensible heat Gain due to Ventilation																																																									
$HL_{vairb} = PVC \times DTD_h \times 1.08 \times (1 - E)$ 95 CFM x 78 °F x 1.08 x 0.25 = 2004 Btu/h			$HL_{vairb} = PVC \times DTD_h \times 1.08 \times (1 - E)$ 95 CFM x 13 °F x 1.08 x 0.25 = 330 Btu/h																																																									
5.2.3.3 Calculation of Air Change Heat Loss for Each Room (Floor Multiplier Section)																																																												
$HL_{airr} = Level\ Factor \times HL_{airbv} \times \{(HL_{agcr} + HL_{bgcr}) \div (HL_{agclevel} + HL_{bgclevel})\}$																																																												
Level	Level Factor (LF)	HLairve Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{clevel})	Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)																																																								
1	0.5	13,072	8,583	0.762																																																								
2	0.3		14,275	0.275																																																								
3	0.2		13,882	0.188																																																								
4	0		0	0.000																																																								
5	0		0	0.000																																																								
*HLairbv = Air leakage heat loss + ventilation heat loss *For a balanced or supply only ventilation system HLairve = 0																																																												

HEAT LOSS AND GAIN SUMMARY SHEET

MODEL: 4504 FLANKAGE	OPT. 2ND	BUILDER: ROYAL PINE HOMES
SFQT: 3309	LO# 87518	SITE: CENTREFIELD (WEST GORMLEY)

DESIGN ASSUMPTIONS

HEATING	°F	COOLING	°F
OUTDOOR DESIGN TEMP.	-6	OUTDOOR DESIGN TEMP.	88
INDOOR DESIGN TEMP.	72	INDOOR DESIGN TEMP. (MAX 75°F)	75

BUILDING DATA

ATTACHMENT:	DETACHED	# OF STORIES (+BASEMENT):	3
FRONT FACES:	EAST	ASSUMED (Y/N):	Y
AIR CHANGES PER HOUR:	2.50	ASSUMED (Y/N):	Y
AIR TIGHTNESS CATEGORY:	TIGHT	ASSUMED (Y/N):	Y
WIND EXPOSURE:	SHELTERED	ASSUMED (Y/N):	Y
HOUSE VOLUME (ft ³):	42928.0	ASSUMED (Y/N):	Y
INTERNAL SHADING:	BLINDS/CURTAINS	ASSUMED OCCUPANTS:	6
INTERIOR LIGHTING LOAD (Btu/h/ft ²):	1.27	DC BRUSHLESS MOTOR (Y/N):	Y
FOUNDATION CONFIGURATION	BCIN_1	DEPTH BELOW GRADE:	6.0 ft
LENGTH: 46.0 ft	WIDTH: 39.0 ft	EXPOSED PERIMETER:	170.0 ft


2012 OBC - COMPLIANCE PACKAGE		Compliance Package	
Component		SB-12 PERFORMANCE	
		Nominal	Min. Eff.
Ceiling with Attic Space Minimum RSI (R)-Value		60	59.20
Ceiling Without Attic Space Minimum RSI (R)-Value		31	27.70
Exposed Floor Minimum RSI (R)-Value		31	29.80
Walls Above Grade Minimum RSI (R)-Value		22+1.5	18.50
Basement Walls Minimum RSI (R)-Value		20	21.12
Below Grade Slab Entire surface > 600 mm below grade Minimum RSI (R)-Value		-	-
Edge of Below Grade Slab ≤ 600 mm Below Grade Minimum RSI (R)-Value		10	10
Heated Slab or Slab ≤ 600 mm below grade Minimum RSI (R)-Value		10	11.13
Windows and Sliding Glass Doors Maximum U-Value		1.6	-
Skylights Maximum U-Value		2.6	-
Space Heating Equipment Minimum AFUE		0.96	-
HRV Minimum Efficiency		75%	-
Domestic Hot Water Heater Minimum EF		TE=94%	-

INDIVIDUAL BCIN: 19669
MICHAEL O'ROURKE



Residential Foundation Thermal Load Calculator

Supplemental tool for CAN/CSA-F280

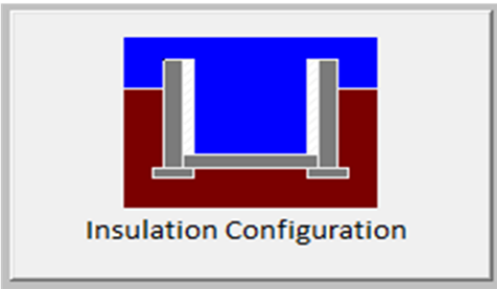Weather Station Description		
Province:	Ontario	
Region:	Richmond Hill	
Site Description		
Soil Conductivity:	Normal conductivity: dry sand, loam, clay	
Water Table:	Normal (7-10 m, 23-33 ft)	
Foundation Dimensions		
Floor Length (m):	14.0	
Floor Width (m):	11.9	
Exposed Perimeter (m):	0.0	
Wall Height (m):	2.7	
Depth Below Grade (m):	1.83	
Window Area (m ²):	1.9	
Door Area (m ²):	1.9	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	33	
Design Months		
Heating Month	1	
Foundation Loads		
Heating Load (Watts):		1685

TYPE: 4504 FLANKAGE
LO# 87518

OPT. 2ND


Air Infiltration Residential Load Calculator

Supplemental tool for CAN/CSA-F280

Weather Station Description				
Province:	Ontario			
Region:	Richmond Hill			
Weather Station Location:	Open flat terrain, grass			
Anemometer height (m):	10			
Local Shielding				
Building Site:	Suburban, forest			
Walls:	Heavy			
Flue:	Heavy			
Highest Ceiling Height (m):	6.40			
Building Configuration				
Type:	Detached			
Number of Stories:	Two			
Foundation:	Full			
House Volume (m ³):	1215.6			
Air Leakage/Ventilation				
Air Tightness Type:	Energy Star Detached (2.5 ACH)			
Custom BDT Data:	ELA @ 10 Pa.	1134.7 cm ²		
	2.50	ACH @ 50 Pa		
Mechanical Ventilation (L/s):	Total Supply	Total Exhaust		
	45.0	45.0		
Flue Size				
Flue #:	#1	#2	#3	#4
Diameter (mm):	0	0	0	0
Natural Infiltration Rates				
Heating Air Leakage Rate (ACH/H):	0.219			
Cooling Air Leakage Rate (ACH/H):	0.068			

TYPE: 4504 FLANKAGE
LO# 87518

OPT. 2ND

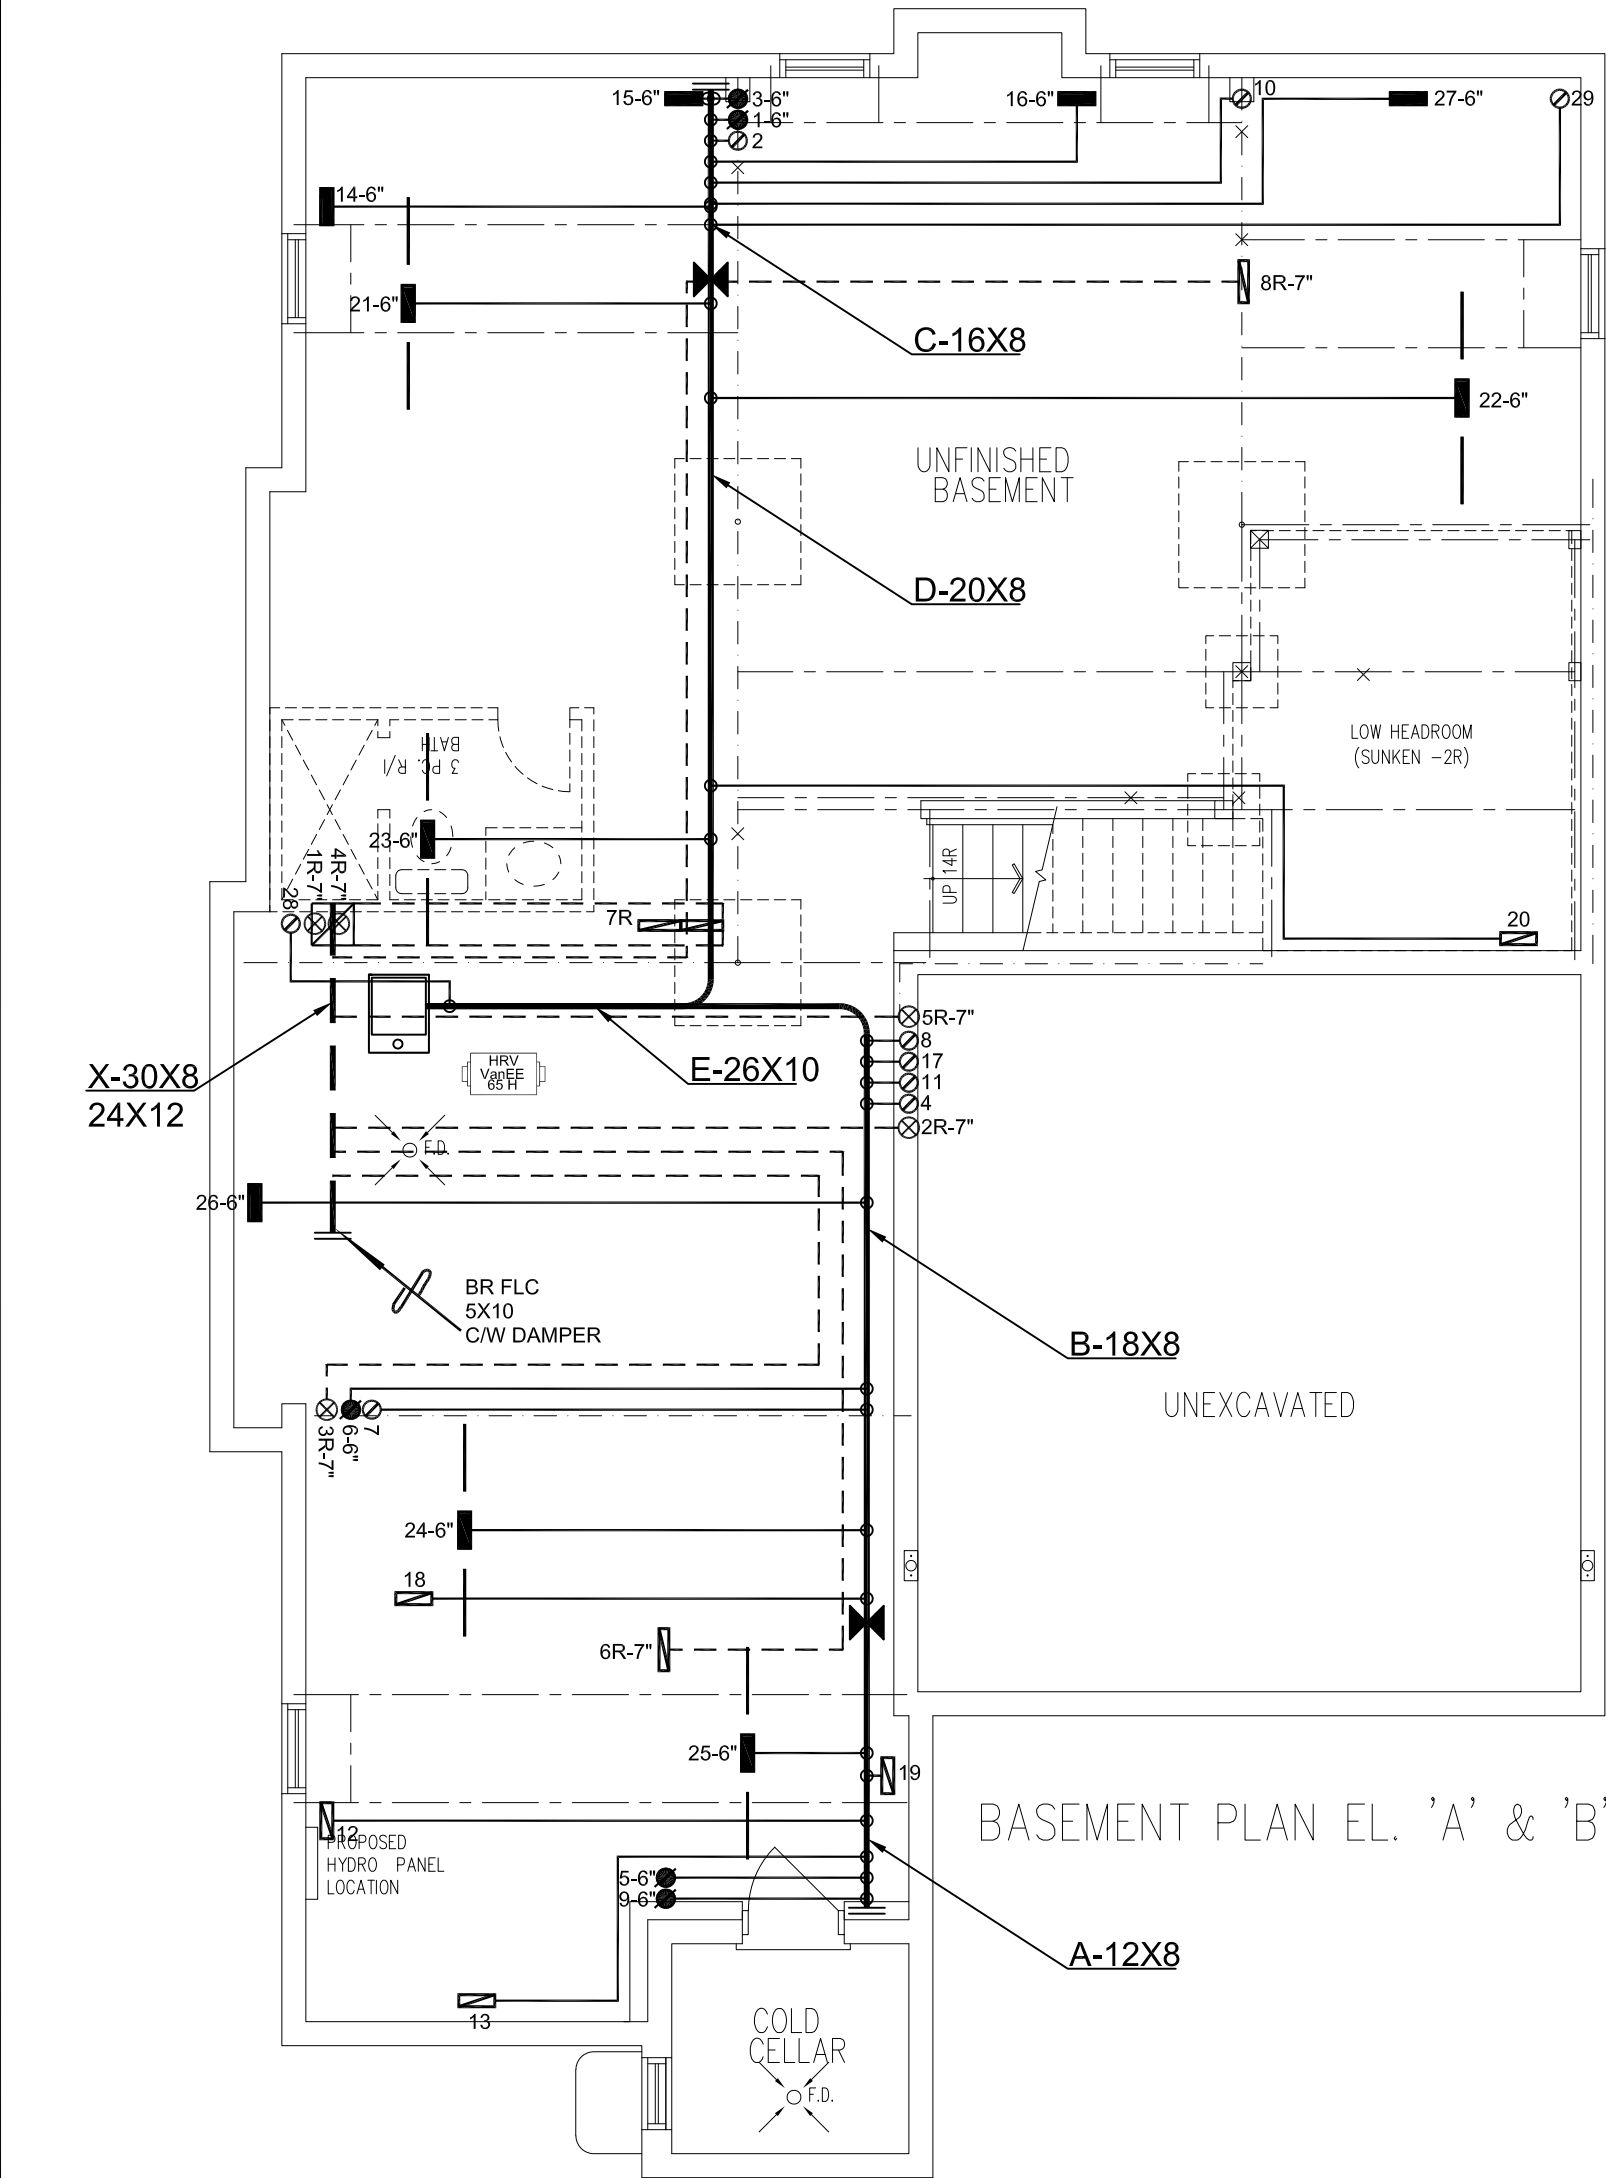

BASEMENT PLAN EL. 'A' & 'B'

I MICHAEL O'ROURKE HAVE REVIEW AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C, 3.2.5 OF THE BUILDING CODE.

Michael O'Rourke
Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.


CSA-F280-12

SB-12 PERFORMANCE

HVAC LEGEND								3.	REVISED AS PER CAD	JUNE/2021
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	2.	REVISED AS PER ARCHITECTURALS	APR/2021
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	1.	REVISED TO PERFORMANCE	SEPT/2020
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	No.	Description	Date
								REVISIONS		

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client	HVACDESIGNS LTD. 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdesigns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services		HEAT LOSS 52180 BTU/H UNIT DATA		# OF RUNS S/A R/A FANS			Sheet Title	
ROYAL PINE HOMES			MAKE CARRIER	3RD FLOOR				BASEMENT HEATING LAYOUT	
Project Name	CENTREFIELD (WEST GORMLEY) RICHMOND HILL, ONTARIO		MODEL 59TN6A-060-14V	2ND FLOOR	14	5	4		
			INPUT 60 MBTU/H	1ST FLOOR	10	3	2	Date SEPT/2020	
	OPT. 2ND 4504 FLANKAGE 3309 sqft		OUTPUT 58 MBTU/H	BASEMENT	5	1	0	Scale 3/16" = 1'-0"	
			COOLING 3.5 TONS	ALL S/A DIFFUSERS 4 "x10" UNLESS NOTED OTHERWISE ON LAYOUT. ALL S/A RUNS 5"Ø UNLESS NOTED OTHERWISE ON LAYOUT. UNDERCUT DOORS 1" min. FOR R/A				BCIN# 19669	
			FAN SPEED 1370 cfm @ 0.6" w.c.					LO# 87518	
			Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.						

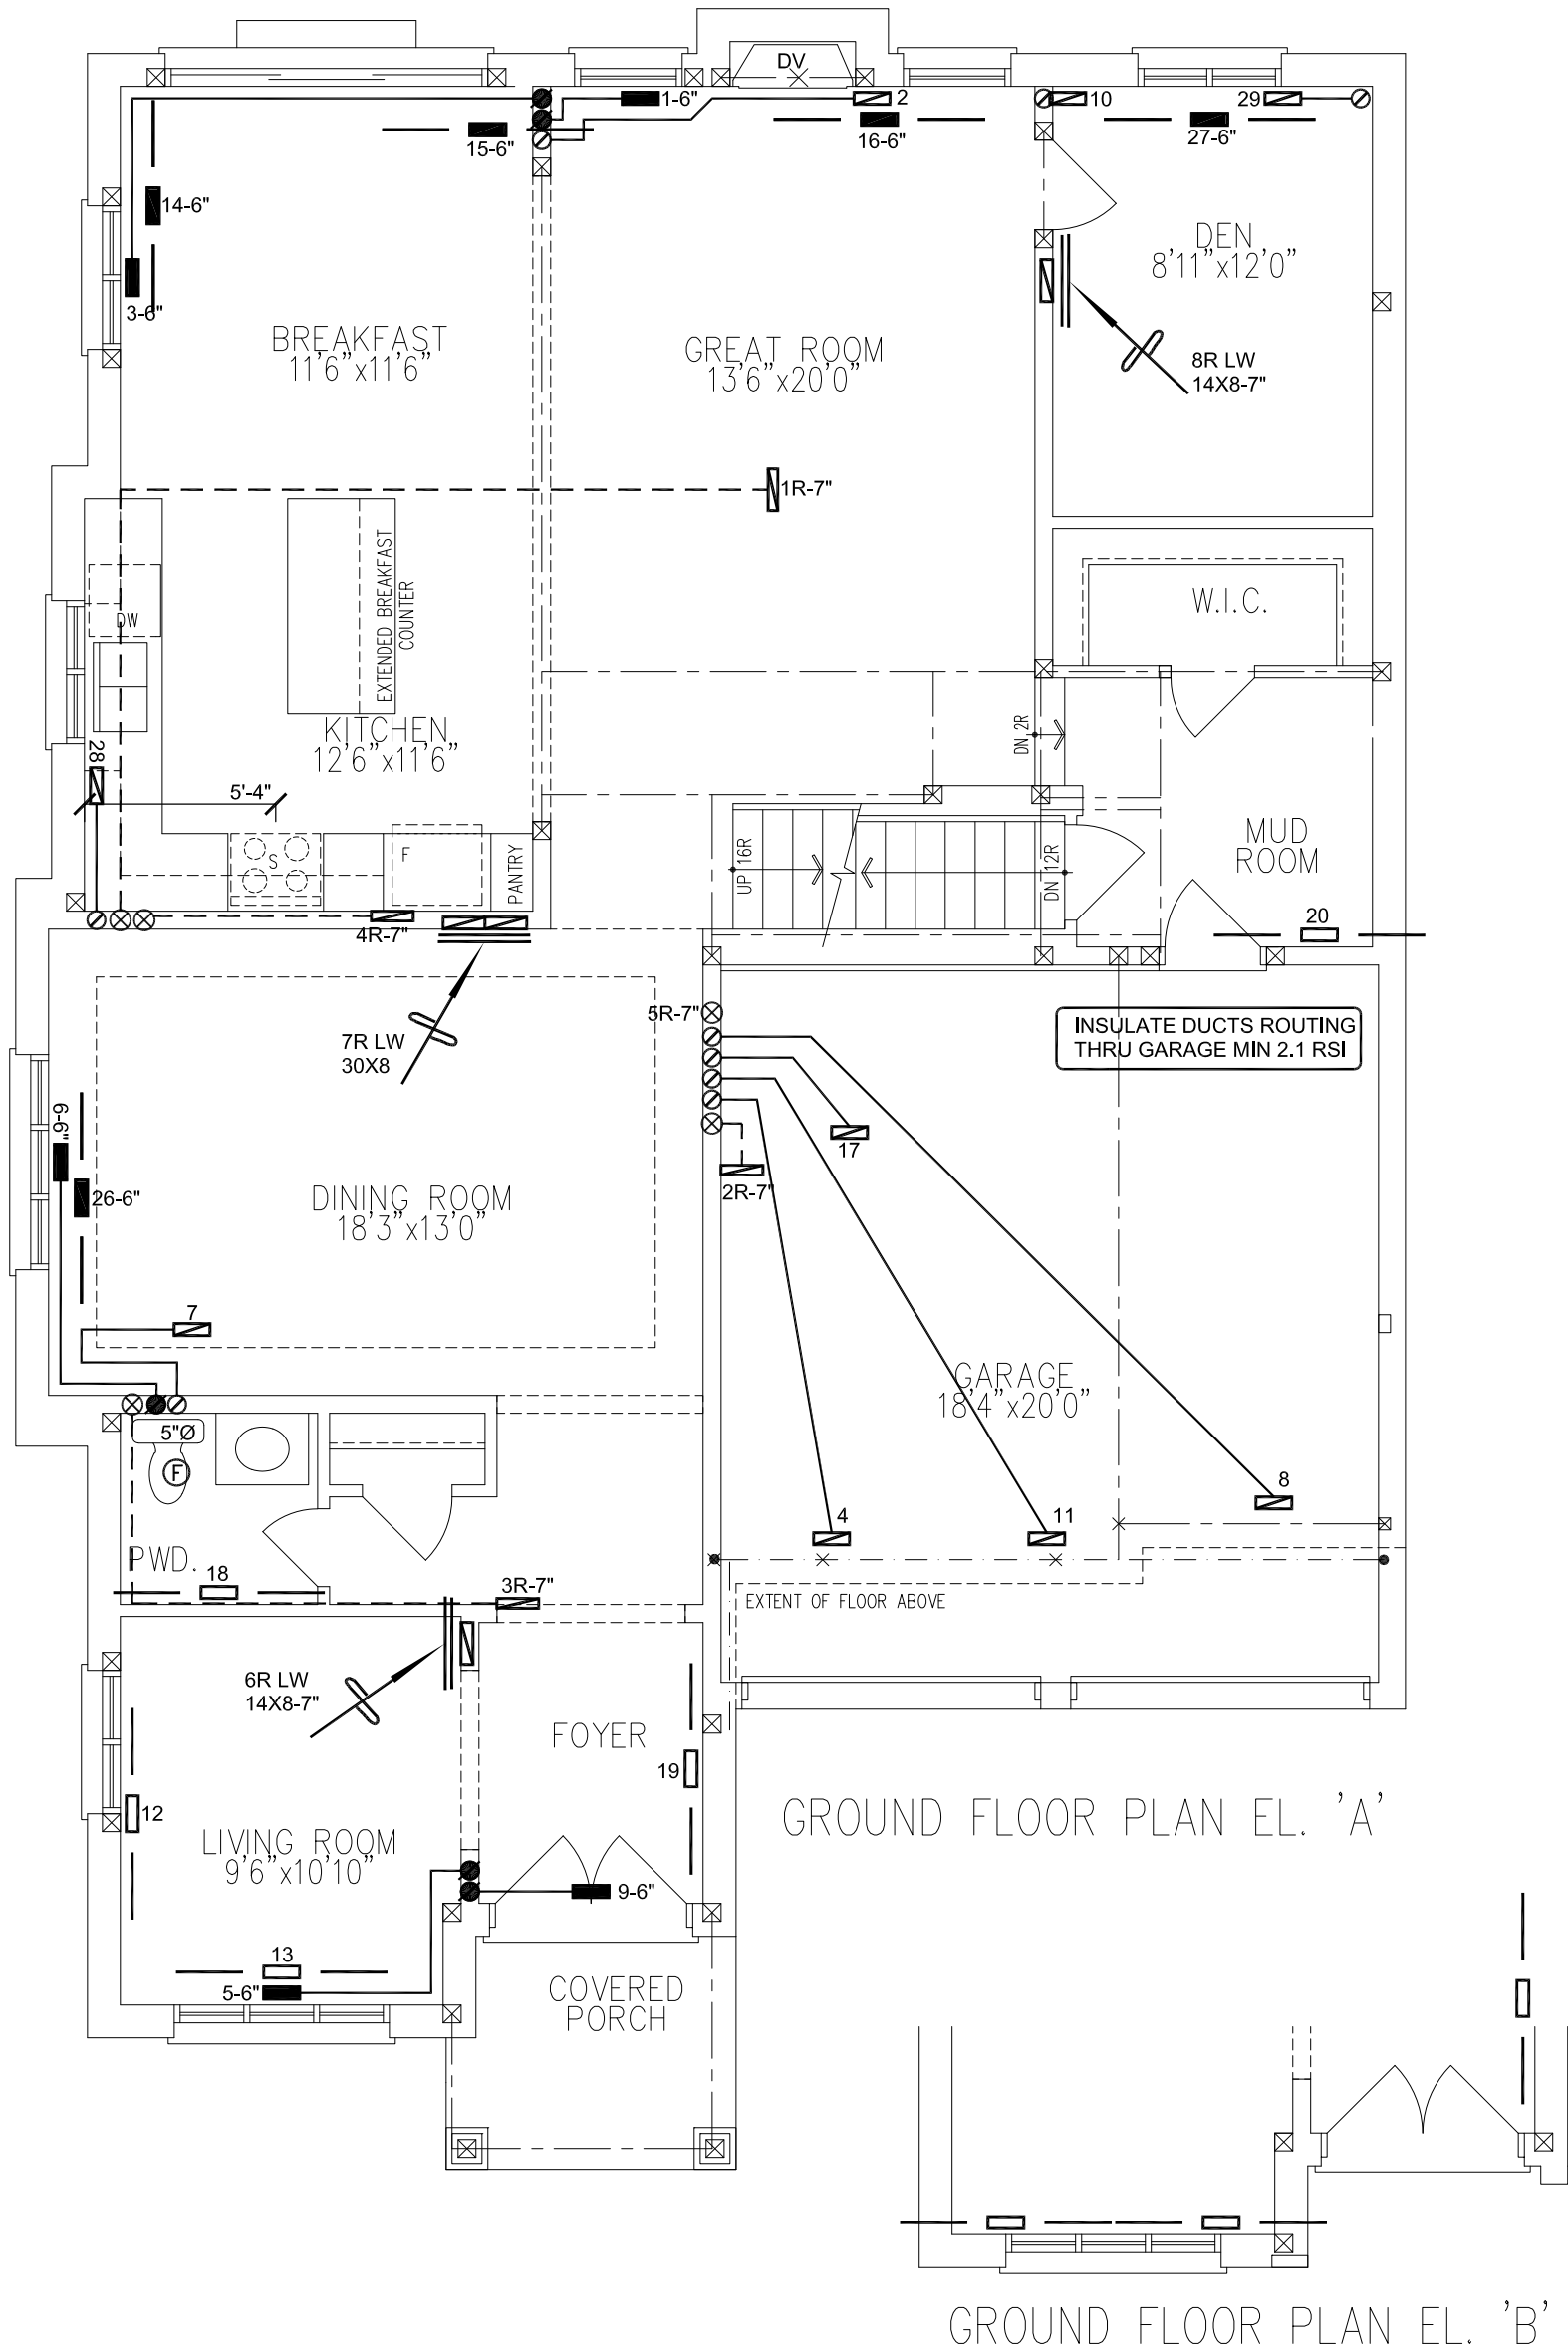

I MICHAEL O'ROURKE HAVE REVIEWED AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C, 3.2.5 OF THE BUILDING CODE.

Michael O'Rourke
Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.


CSA-F280-12

SB-12 PERFORMANCE

HVAC LEGEND								3.	REVISED AS PER CAD	JUNE/2021
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.	REVISED AS PER ARCHITECTURALS	APR/2021
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.	REVISED TO PERFORMANCE	SEPT/2020
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description	Date
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	REVISIONS		

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client		 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdesigns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.	Sheet Title	
ROYAL PINE HOMES			FIRST FLOOR HEATING LAYOUT	
Project Name			Date	SEPT/2020
CENTREFIELD (WEST GORMLEY) RICHMOND HILL, ONTARIO			Scale	3/16" = 1'-0"
OPT. 2ND 4504 FLANKAGE 3309 sqft			BCIN# 19669	
			LO#	87518

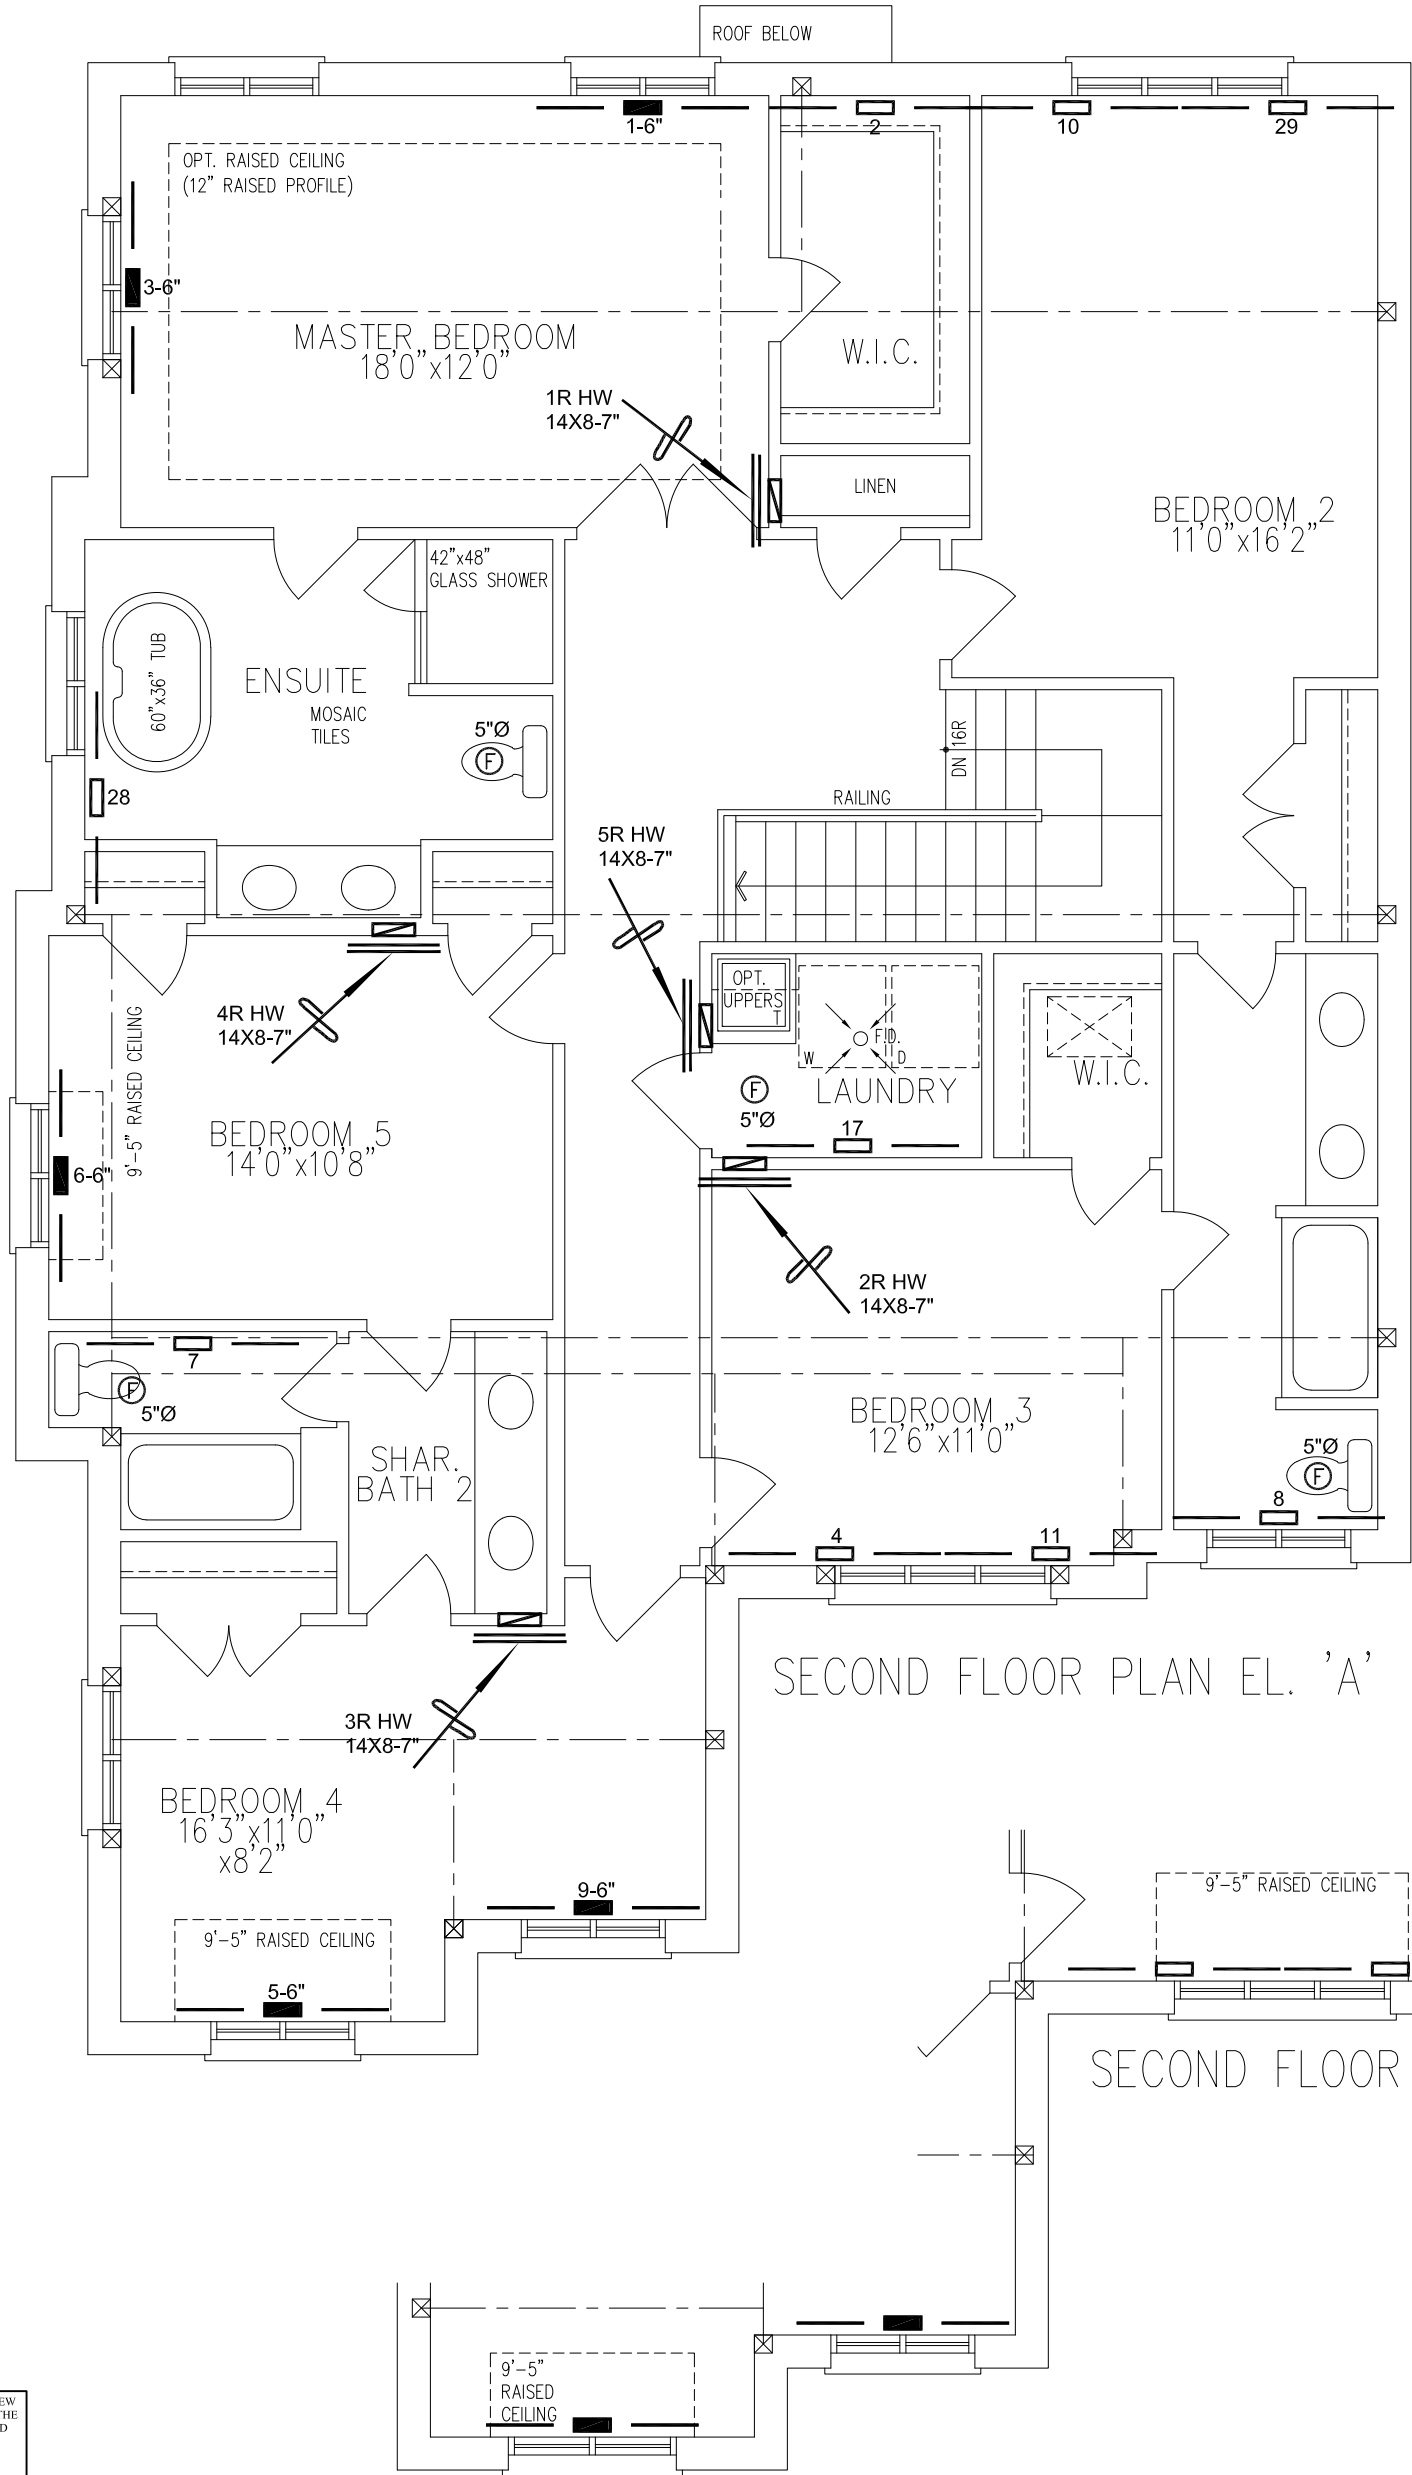

I MICHAEL O'ROURKE HAVE REVIEWED AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C, 3.2.5 OF THE BUILDING CODE.

Michael O'Rourke
Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.

CSA-F280-12

SB-12 PERFORMANCE

HVAC LEGEND								3.	REVISED AS PER CAD	JUNE/2021
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.	REVISED AS PER ARCHITECTURALS	APR/2021
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.	REVISED TO PERFORMANCE	SEPT/2020
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description	Date
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	REVISIONS		

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client		 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdesigns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.	Sheet Title	
ROYAL PINE HOMES			SECOND FLOOR HEATING LAYOUT	
Project Name			Date	SEPT/2020
CENTREFIELD (WEST GORMLEY) RICHMOND HILL, ONTARIO			Scale	3/16" = 1'-0"
OPT. 2ND 4504 FLANKAGE 3309 sqft			BCIN# 19669	
			LO#	87518