


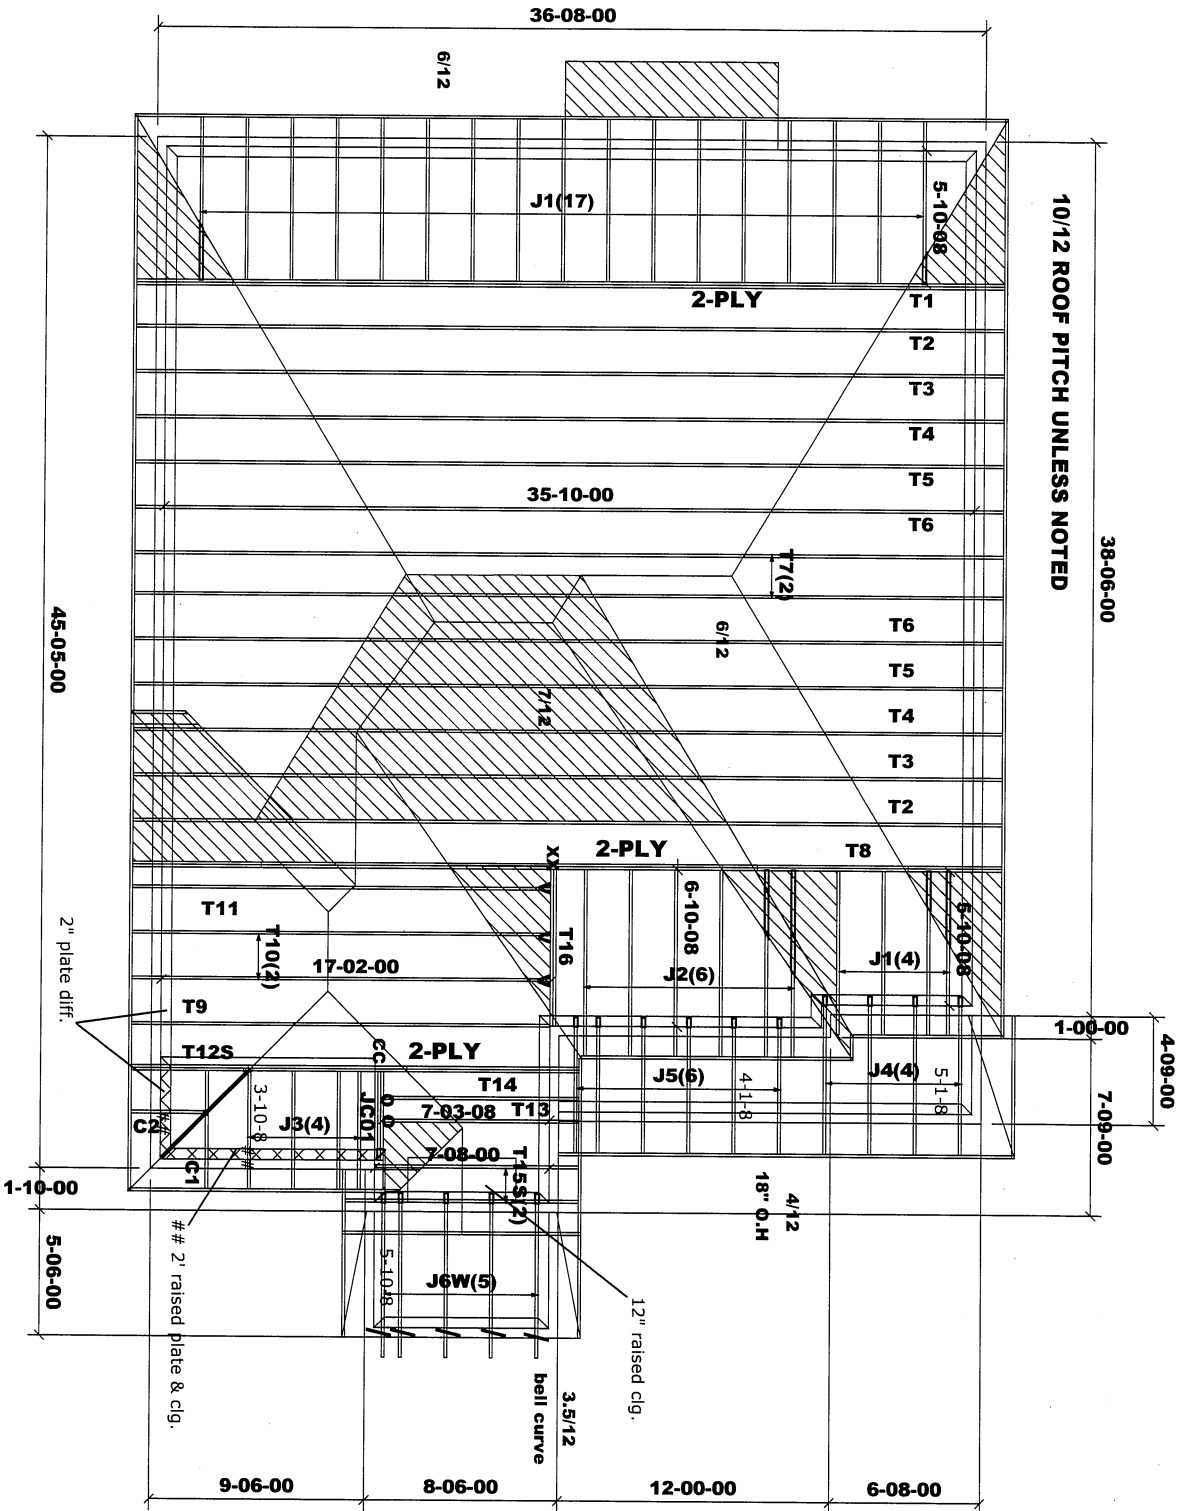

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LUS26DS - (V)
HGUS26-2 - (XX)
HUSC26-2 - (CC)
H2.5T - (I)

 DENOTES:
CONVENTIONAL
FRAMING

M14035

		Job Track: 51004 Plan Log: 203048 Layout ID: 418938		Builder / Location: ROYAL PINE HOMES / RICHMOND HILL		Model / Elevation: UNIT-4501 / A-STD.OR 5 BRM	
Date: 2021-06-04 Sales: Mario DiCiano Designer: JG		Project: CENTREFIELD		THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.			
Mike ver 8.4.2.286							



Job Track: **51004**

Plan Log: **203048**

Layout ID: **410914**

MIH035

Builder / Location:			
ROYAL PINE HOMES / RICHMOND HILL			
Project: CENTREFIELD			
Date:	2017-06-04	Sale:	
	Mario Nucera	Designer: JC	
			THESE DRAWINGS OR REDISTRICT
			TMARACK


Model / Elevation:

UNIT - 4501 / A-STD. WITH OPT.COFF

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMAARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMAARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMAARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

Milex ver 8.4.2.2

Mitek ver 8.4.2.286

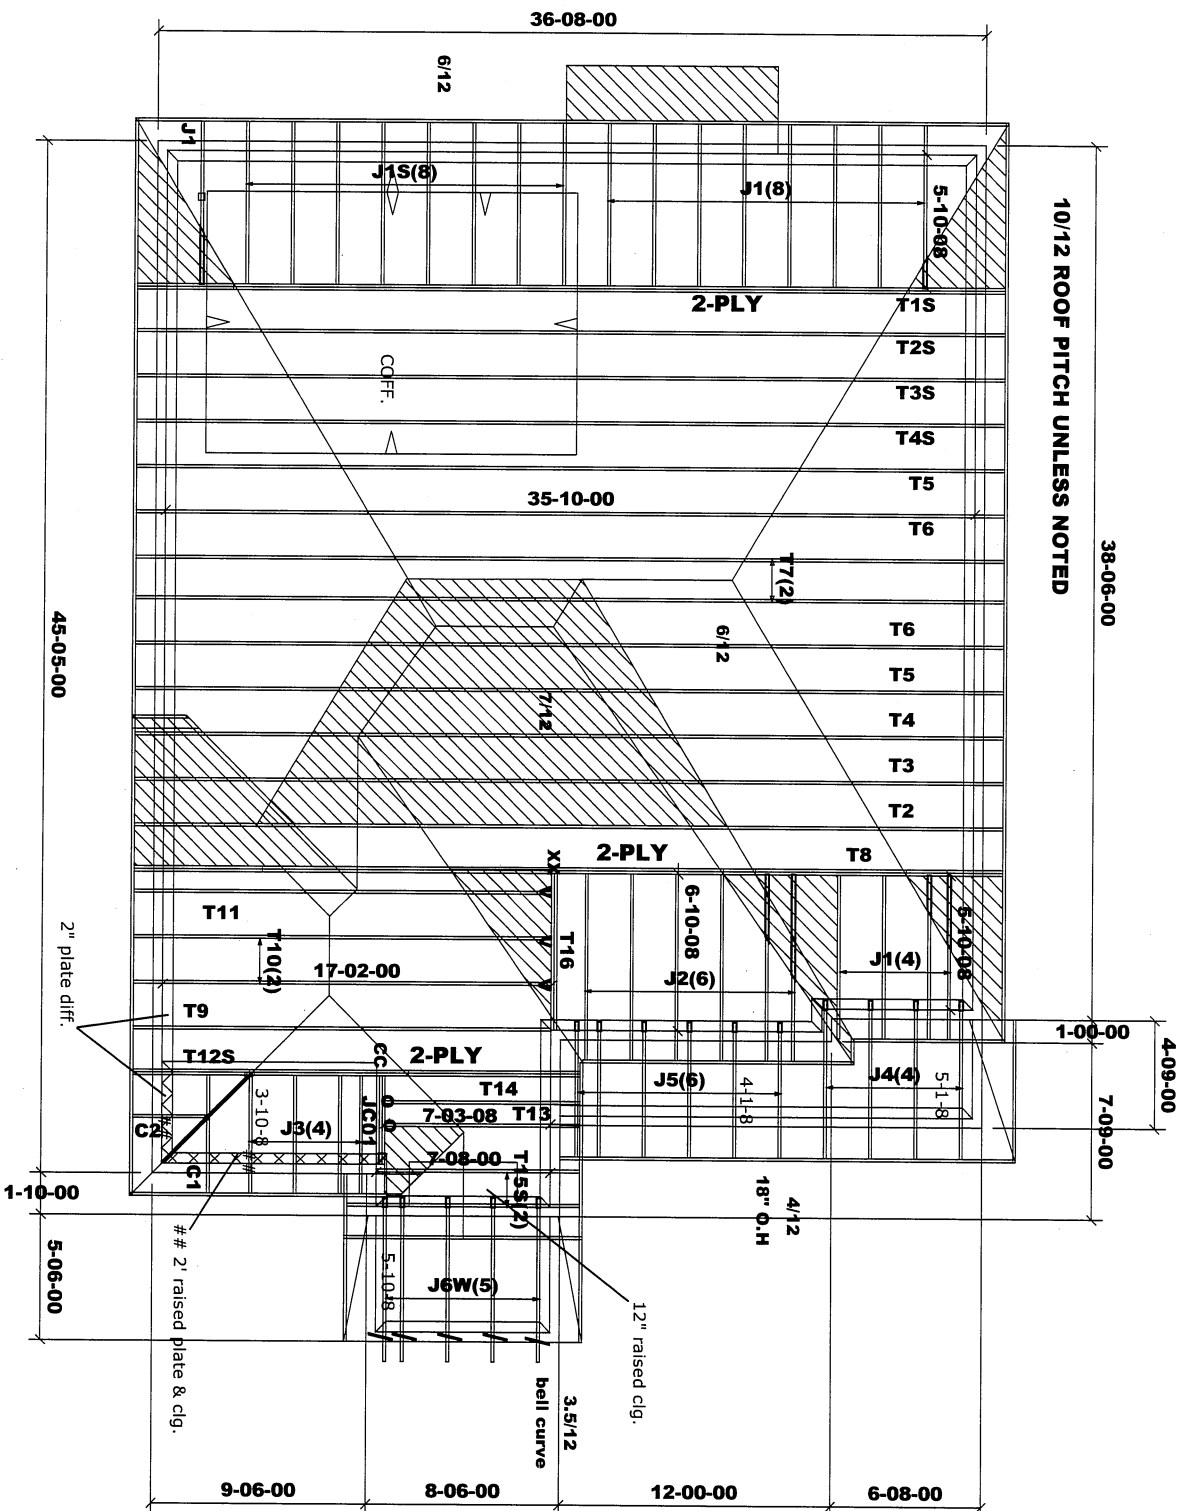

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross vertical. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012
(2019 amendment) OCCUPANCY:
RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
 TC SL = 25.6 psf
 TC DL = 6.0 psf
 BC LL = 0.0 psf
 BC DL = 7.4 psf

HARDWARE:
LUS24 - (O)
LUS26DS - (V)
HGUS26-2 - (XX)
HUSC26-2 - (CC)
H2.5T - (I)

DENOTES:
CONVENTIONAL
FRAMING



TAMARACK
ROOF TRUSSES INC.

Job Track: **51004**

Plan Log: **203048**

Layout ID: **410915**

Builder / Location:			
ROYAL PINE HOMES / RICHMOND HILL			
Project: CENTREFIELD			
Date:	2024-06-04	Release:	Make-Do-Use-It
		Deadline:	IN TAMAARACK
			OR REDIST/IT
			THESE DRA


Model / Elevation:

UNIT-4501 / A-5 BRW WITH OPT. COFFER

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

Mtek ver 8.4.2 2866

Mitek ver 8.4.2.286

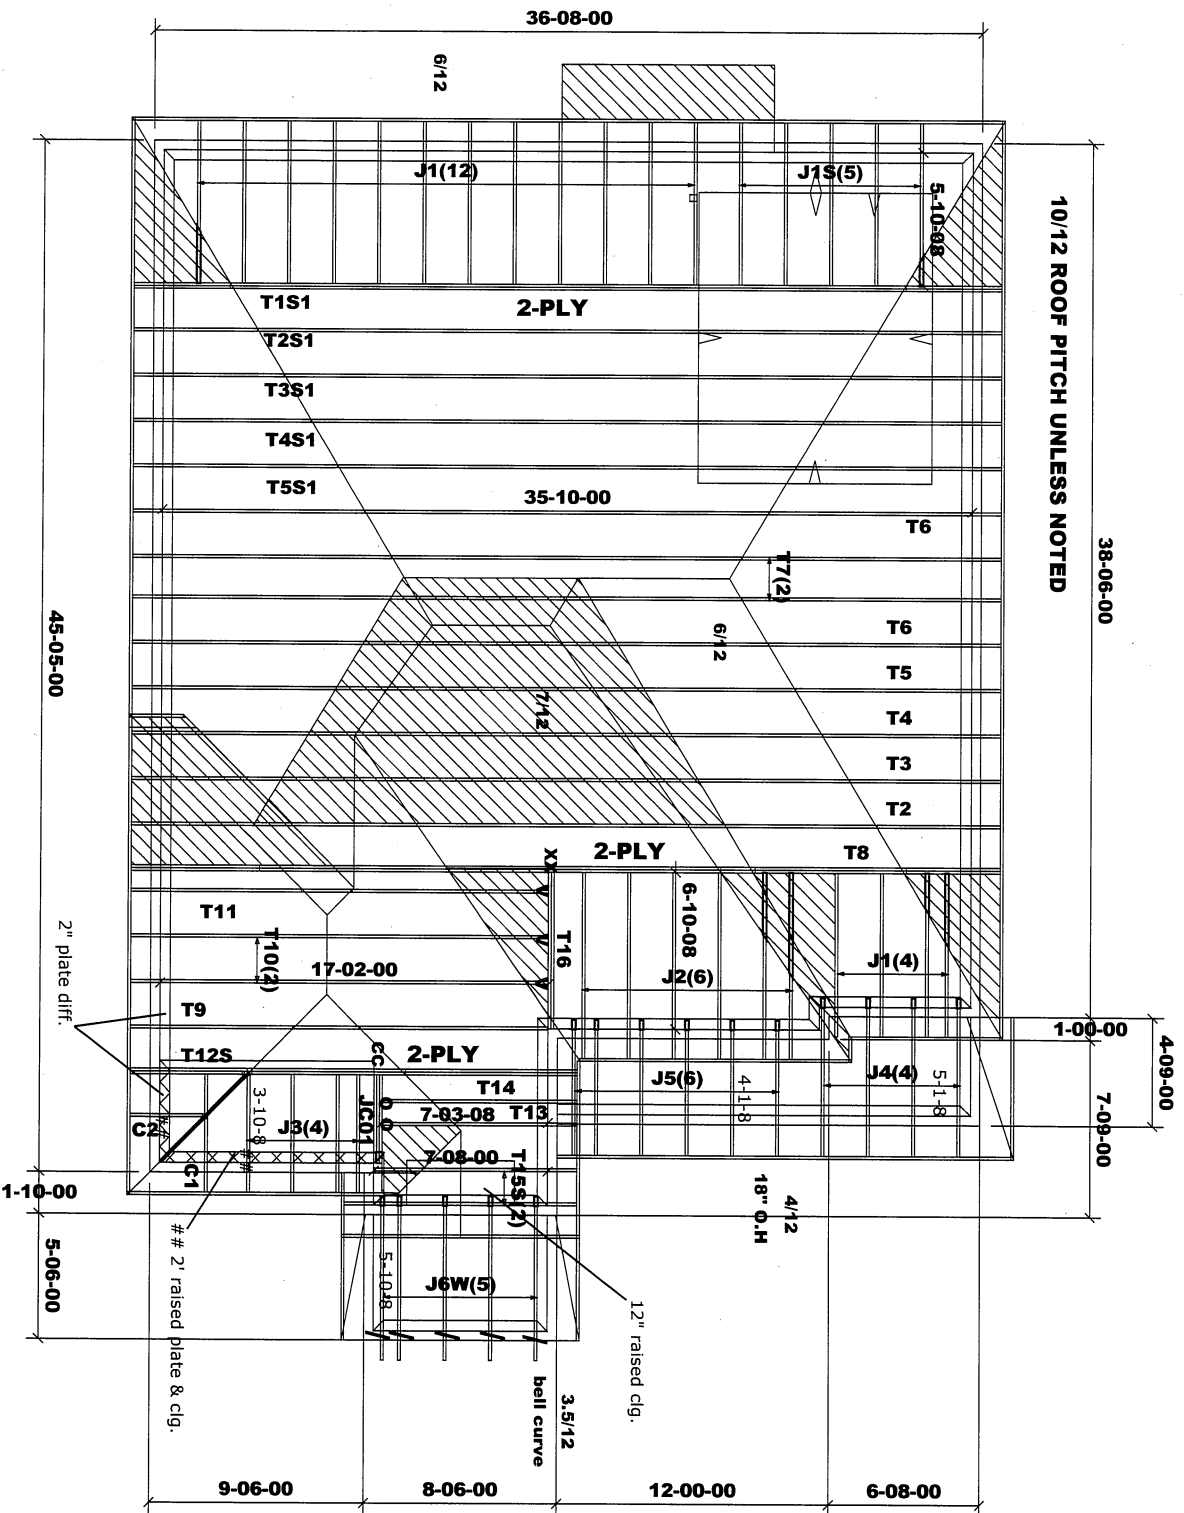

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012
(2019 amendment) OCCUPANCY:
RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf


DESIGN LOADS:

TCSL = 25.6 psf
 TC DL = 6.0 psf
 BC LL = 0.0 psf
 BC DL = 7.4 psf

HARDWARE:

LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)
HUSC26-2 - (CC)
H2.5T - (I)

DENOTES:
CONVENTIONAL
FRAMING

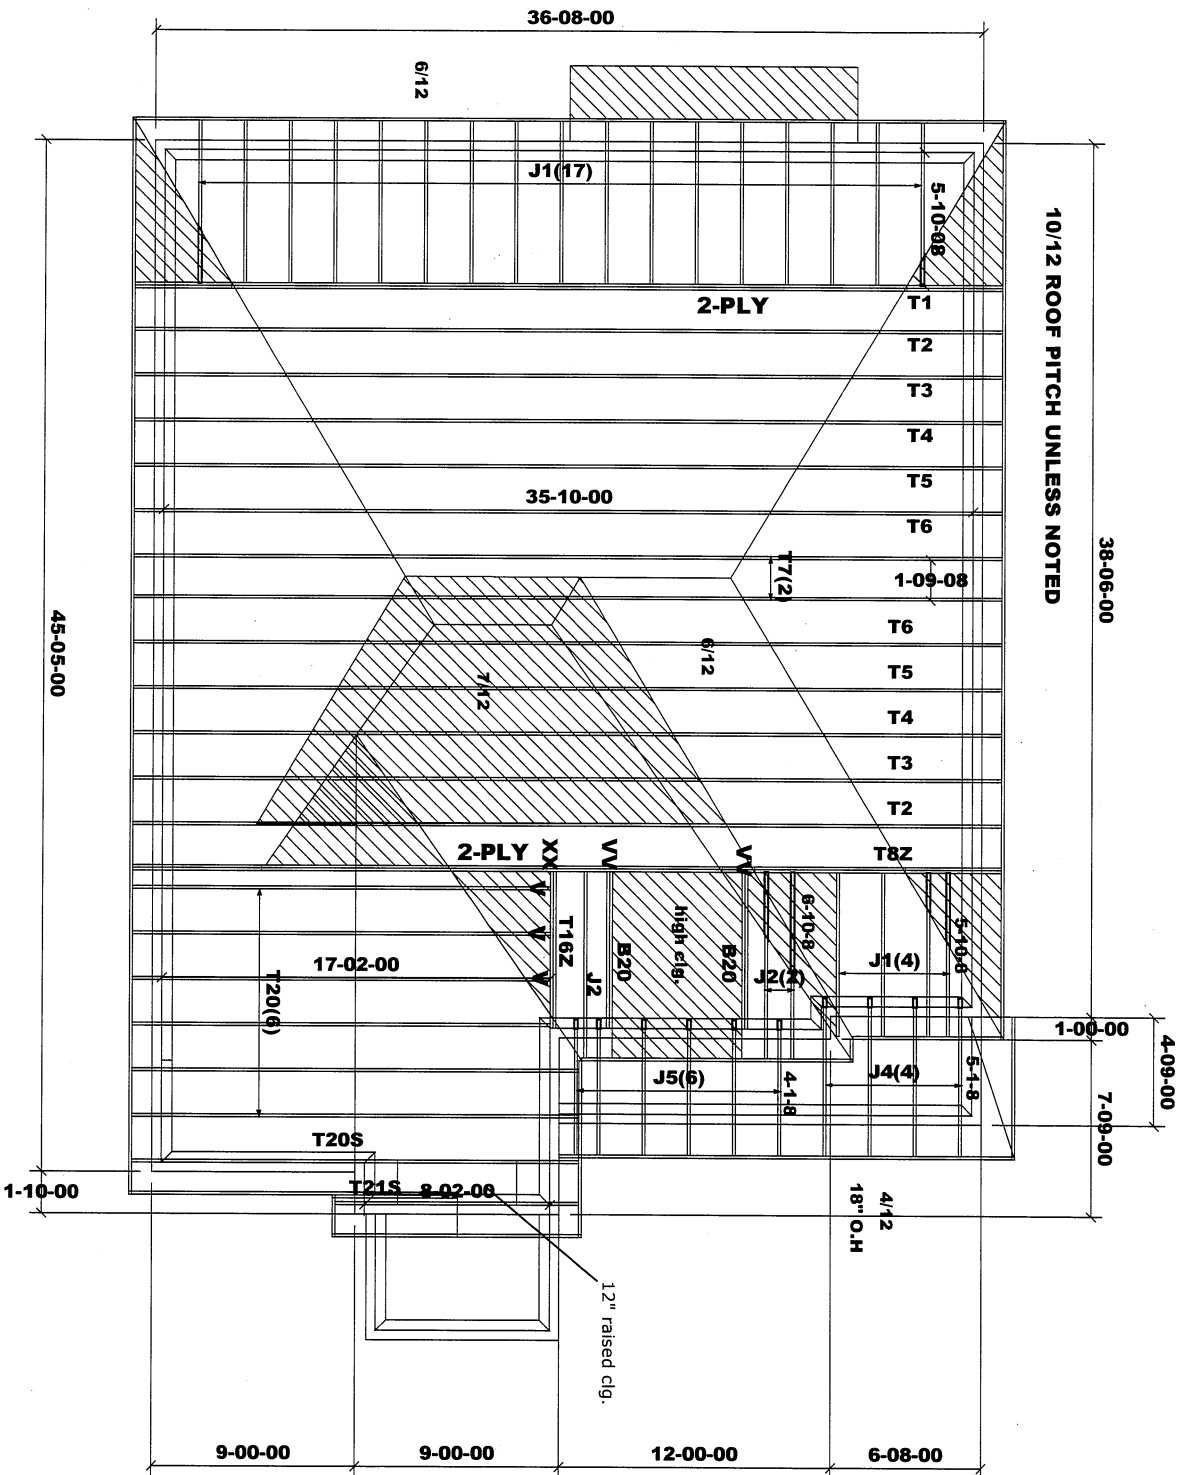

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.


All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGS26-2 - (XX)
LUS26-2 - (VV)

BEAMS:
B20 = 2 - 2x10 SPF #2



DENOTES:
CONVENTIONAL
FRAMING


M/4635

TAMARACK
ROOF TRUSSES INC.

Job Track: 51004	Builder / Location: ROYAL PINE HOMES / RICHMOND HILL	Model / Elevation: UNIT-4501 / B-STD. OR 5 BRM
Plan Log: 203048	Project: CENTREFIELD	
Layout ID: 418939	Date: 2021-06-04	Sales: Mario DiCano
	Designer: JG	

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

Mitek ver 8.4.2.286

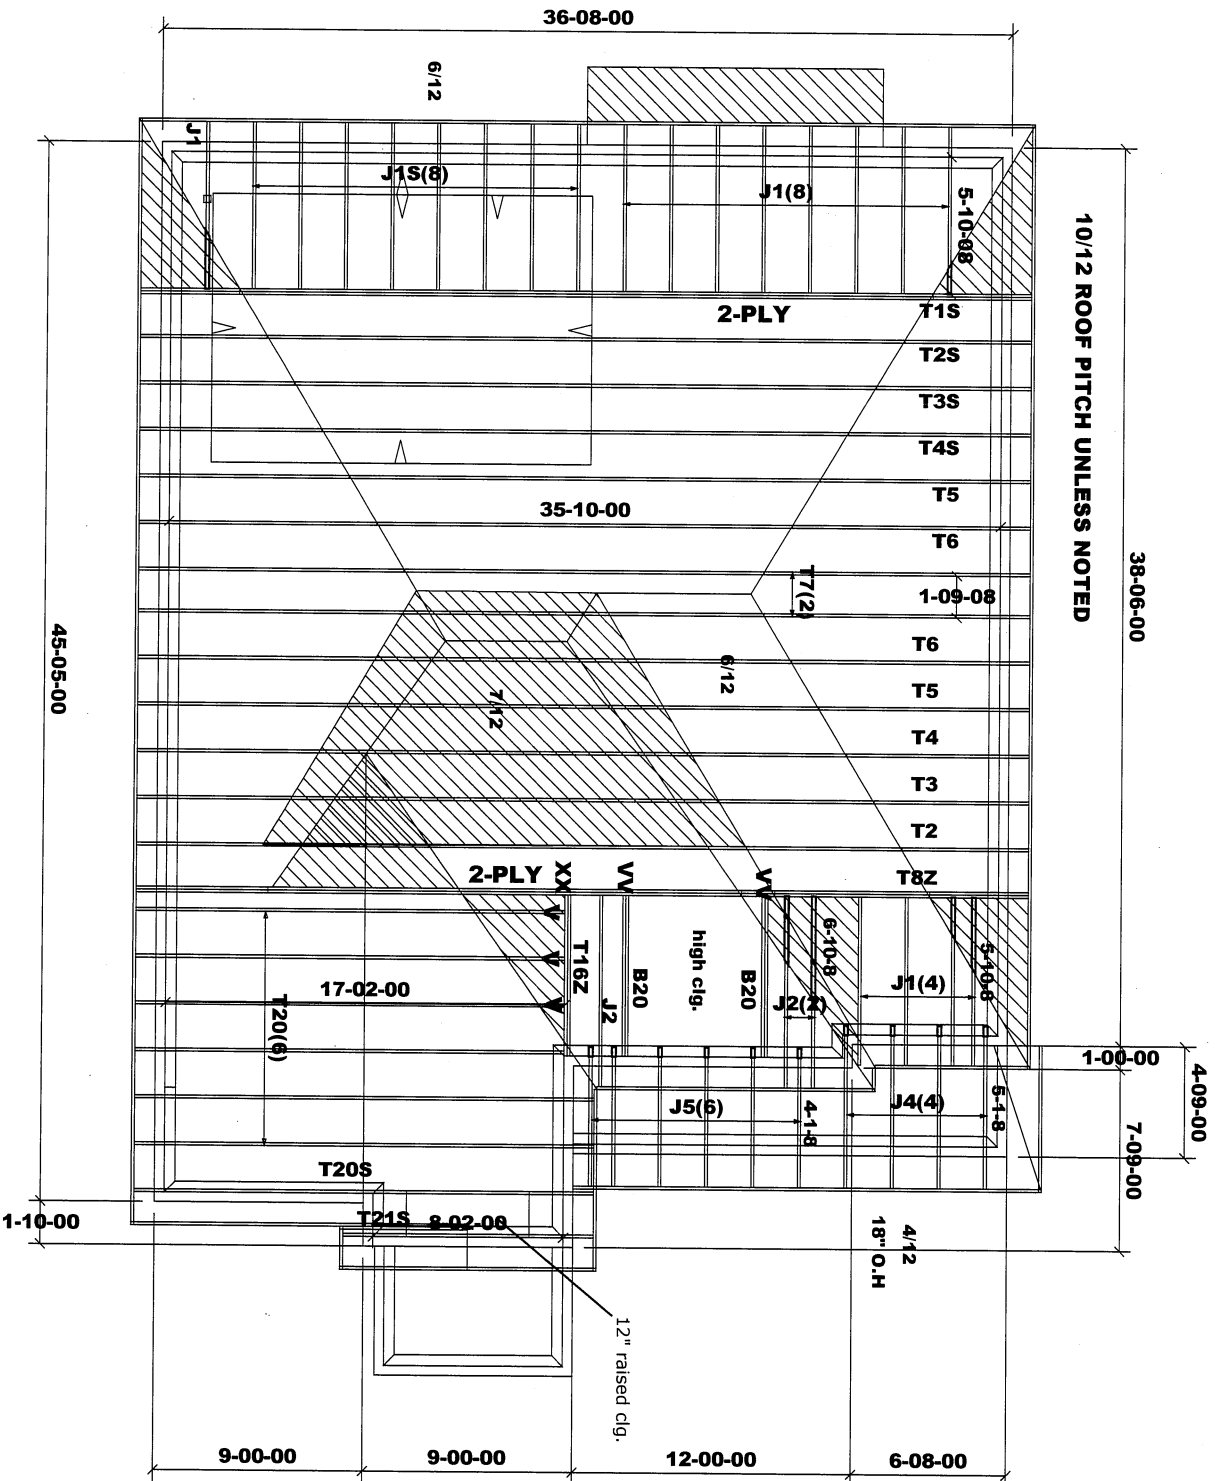

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LUS26DS - (V)
HGUS26-2 - (XX)
LUS26-2 - (VV)

BEAMS:
B20 = 2 - 2x10 SPF #2

CONVENTIONAL FRAMING

M14035

		Job Track: 51004		Builder / Location: ROYAL PINE HOMES / RICHMOND HILL		Model / Elevation: UNIT- 4501 / B-STD. WITH OPT.COFF	
Plan Log: 203048		Project: CENTREFIELD		THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.		Mitek ver 8.4.2.286	
Layout ID: 410916		Date: 2021-06-04		Sales: Mario DiCano		Designer: JG	



TAMARACK
ROOF TRUSSES INC.

Job Track: **51004**

Plan Log: **203048**

Layout ID: **410917**

Builder / Location:	ROYAL PINE HOMES / RICHMOND HILL					
Project:	CENTREFIELD					
Date:	2023-06-04	Release	Made Drawings	Redesign	Location	Notes
						THESE DRAWINGS ARE REDISTRICTED TO THE TAMA RACK

Model / Elevation:

UNIT-4501 / B- 5 BRM WITH OPT. COFF

DENOTES:
CONVENTIONAL
FRAMING


BEAMS:
B20 = 2 - 2x10 SPF #2


HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)
LUS26-2 - (VV)

DESIGN CONFORMS WITH OBC 2012
(2019 amendment) OCCUPANCY:
RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

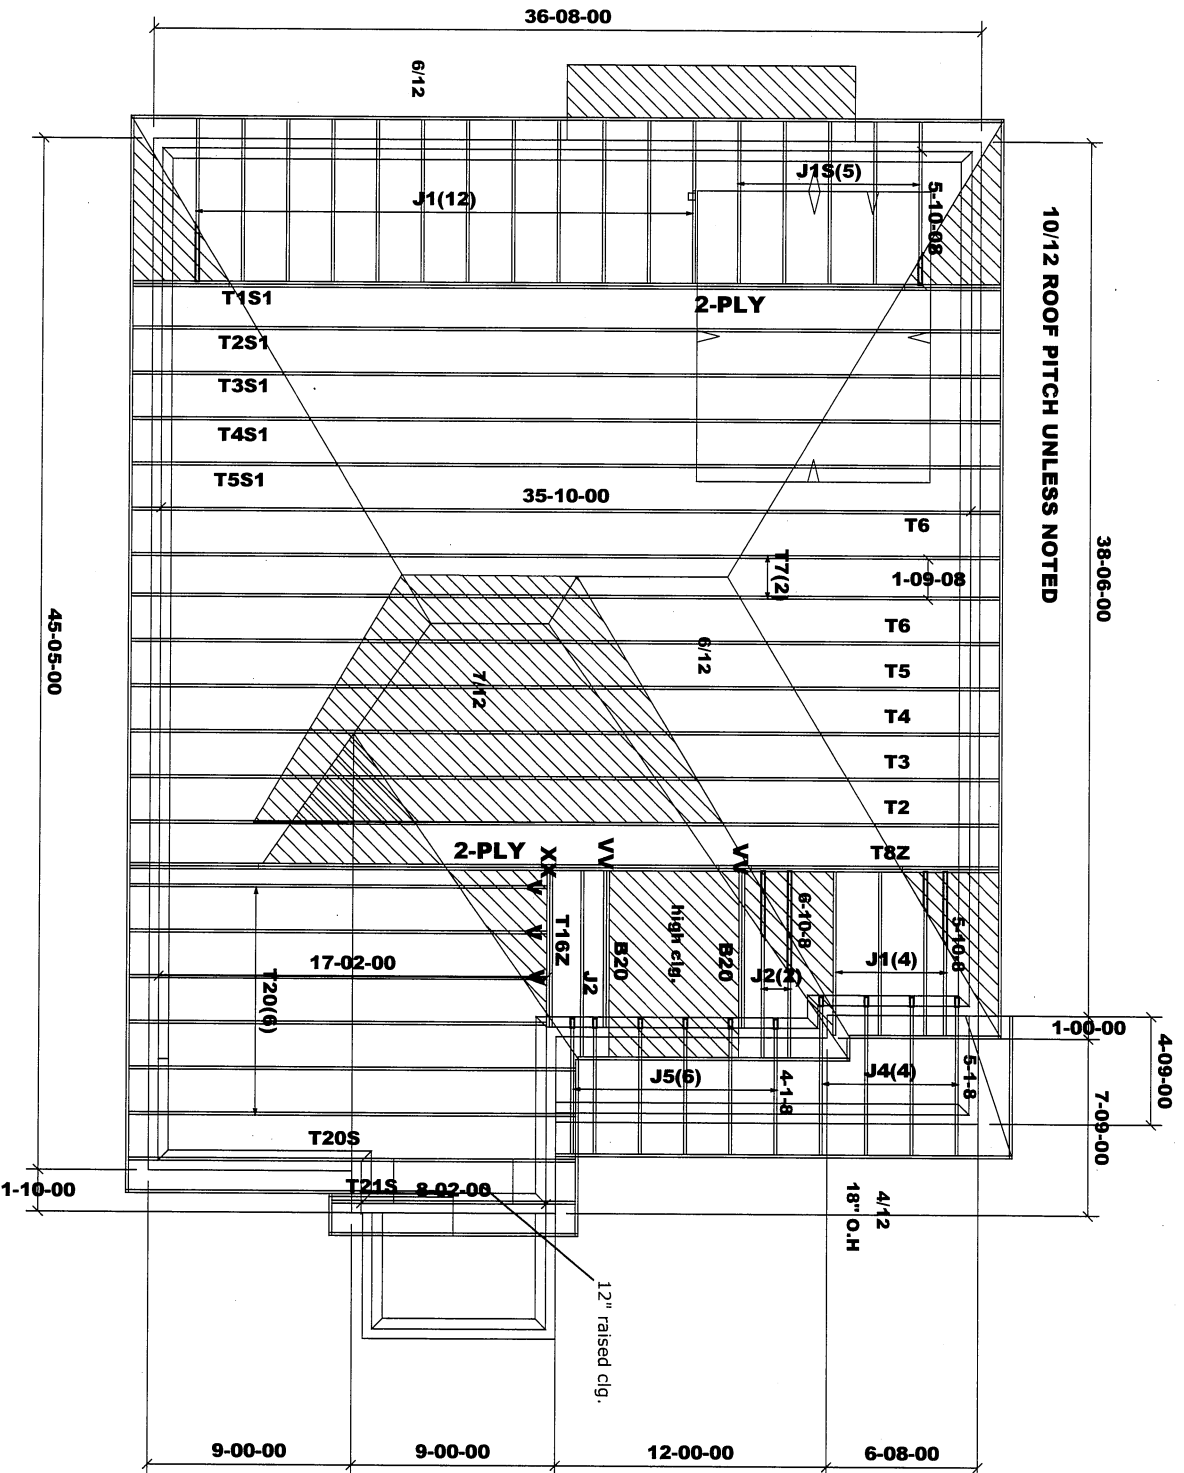

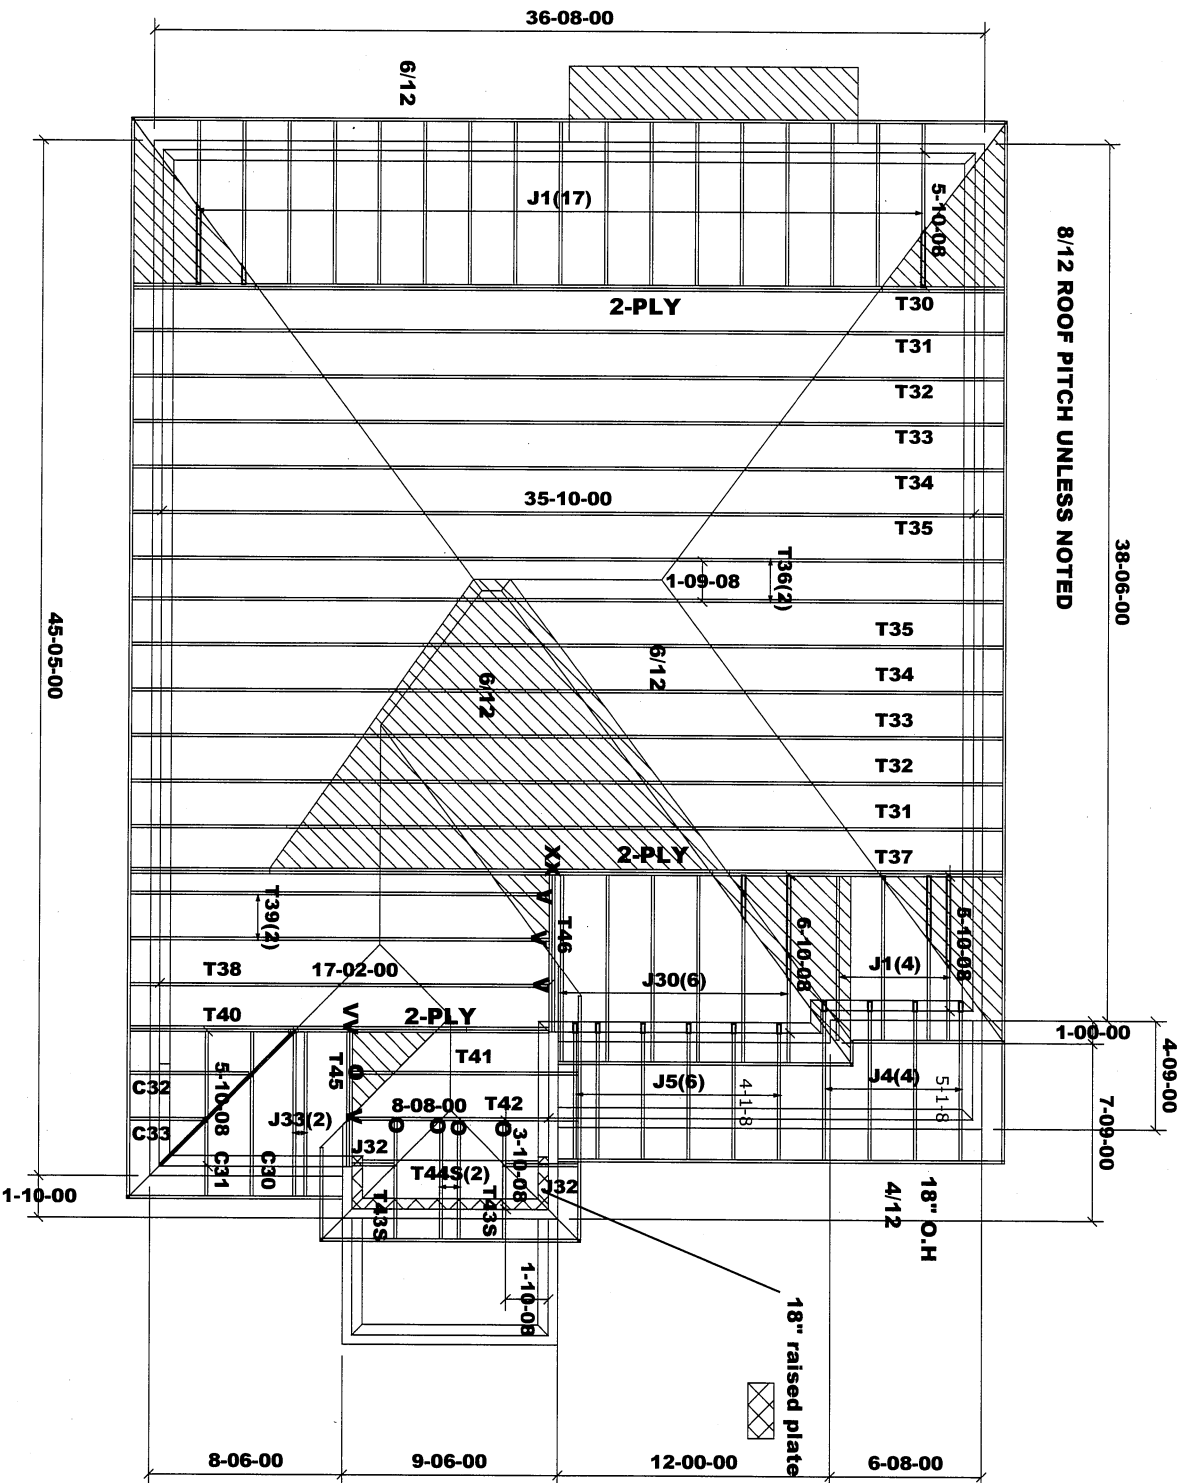

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: RESIDENTIAL | PART: 9

Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:

TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf


HARDWARE:

LUS24 - (O)
LUS26DS - (V)
HGUS26-2 - (XX)
LUS26-2 - (VV)

 **DENOTES:**
CONVENTIONAL
FRAMING

M14035

		Job Track: 51004	Builder / Location: ROYAL PINE HOMES / RICHMOND HILL	Model / Elevation: UNIT-4501 / C-STD.OR 5 BRM		
Plan Log: 203048						
Layout ID: 418940						
Project: CENTREFIELD		THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.				
Date: 2021-06-04	Sales:				Mario DiCano	Designer: JG

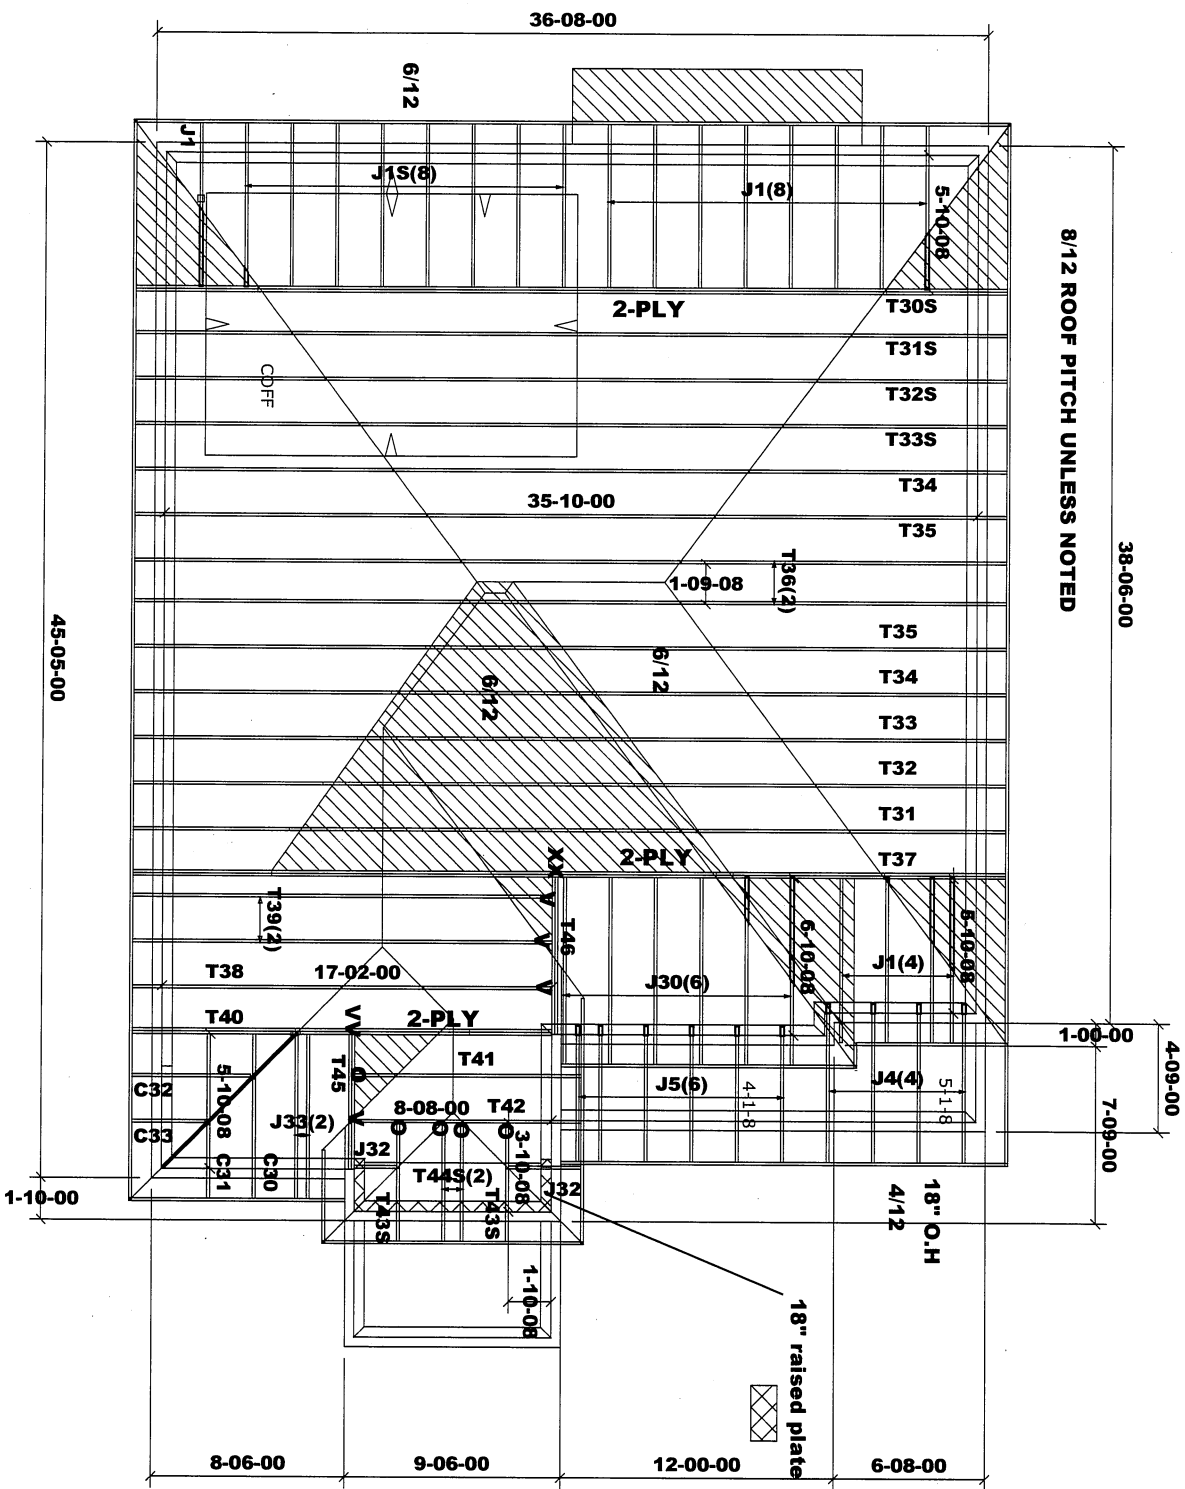

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LUS26DS - (V)
HGUS26-2 - (XX)
LUS26-2 - (VV)

 DENOTES:
CONVENTIONAL
FRAMING

M14035



TAMARACK
ROOF TRUSSES INC.
ESTABLISHED 1988

Job Track: **51004**

Plan Log: **203048**

Layout ID: **410918**

Builder / Location: **ROYAL PINE HOMES / RICHMOND HILL**

Project: **CENTREFIELD**

Date: **2021-06-04**

Sales: **Mario DiCano**

Designer: **JG**

Model / Elevation: **UNIT-4501 / C-STD. WITH OPT.COFF**

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC. AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC. IF UTILIZED FOR ANY OTHER PURPOSE.

Mitek ver 8.4.2.286



TAMARACK
ROOF TRUSSES INC.

Job Track: **51004**

Plan Log: **203048**

Layout ID: **410919**

Builder / Location: ROYAL PINE HOMES / RICHMOND HILL			
Project: CENTREFIELD			
Date:	2023-06-04	Selected:	THESE DRAWINGS OR REDISPLAY TAMAARACK
	Media: D:\Pine	Product: JG	


Model / Elevation:

UNIT-4501 / C- 5 BRM. WITH OPT. COFF

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

Mitek ver 8.4.2.286

Mitek ver 8.4.2.286

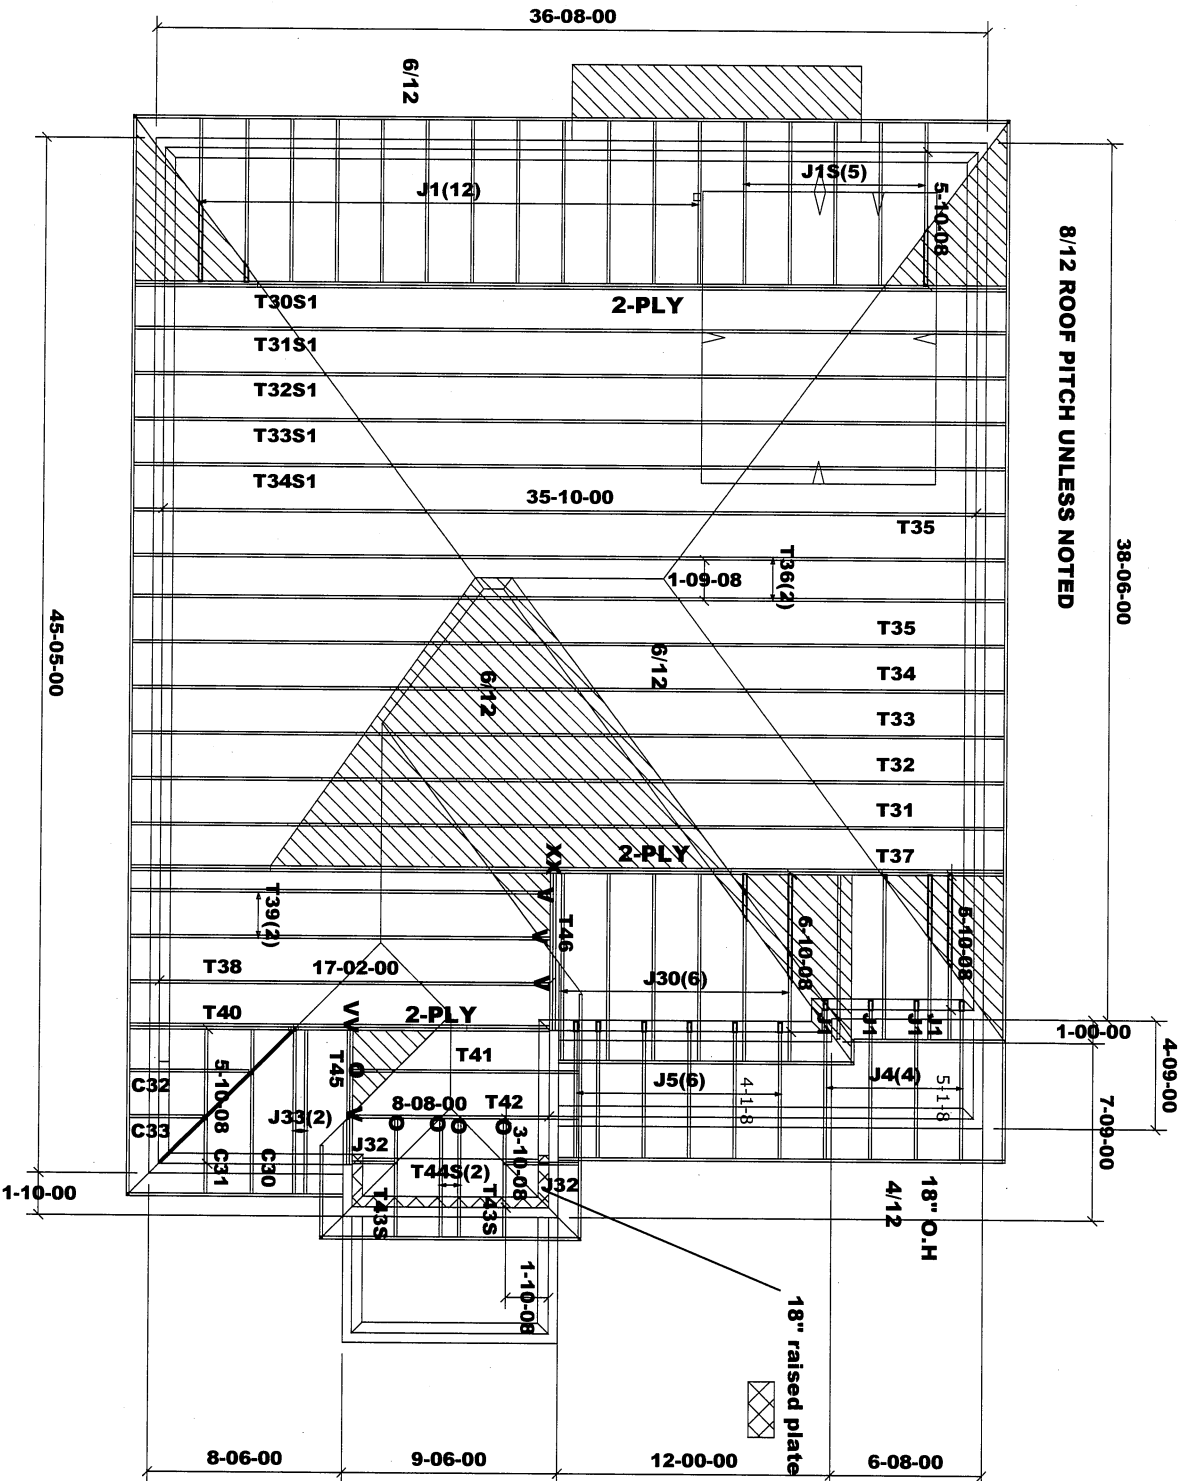

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end and points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012
(2019 amendment) OCCUPANCY:

$S_s = 31.35 \text{ psf} \mid S_r = 8.4 \text{ psf}$


DESIGN LOADS:

TC_{SL} = 25.6 psf
TC_{DL} = 6.0 psf
BC_{LL} = 0.0 psf
BC_{DL} = 7.4 psf

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)
LUS26-2 - (VV)



DENOTES:
CONVENTIONAL
FRAMING

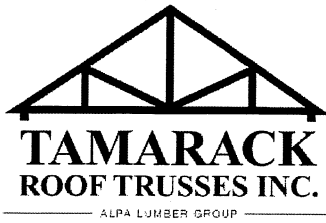


DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: CENTREFIELD
 Location: RICHMOND HILL
 Model: UNIT-4501
 Lot #:
 Elevation: A-STD.OR 5 BRM











Job Track: 51004
 PlanLog: 203048
 Layout ID: 418938
 Ref #
 Page: 1 of 3
 Date: 06-04-2021
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	10 / 12	35-10-00	4-01-11	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	404.68 237.33		
	2	T2 Hip	10 / 12	35-10-00	5-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	297.34 187.00		
	2	T3 Hip	10 / 12	35-10-00	6-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	300.3 190.00		
	2	T4 Hip	10 / 12	35-10-00	7-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	326.86 204.33		
	2	T5 Hip	10 / 12	35-10-00	8-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	322.73 202.00		
	2	T6 Hip	10 / 12	35-10-00	9-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	366.94 228.67		
	2	T7 Hip	10 / 12	35-10-00	10-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	350.64 220.00		
	1 2-ply	T8 Roof Special Girder	10 / 12	35-10-00	5-03-15	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	394.64 240.00		
	1	T9 Hip	10 / 12	17-02-00	8-06-07	2 x 4	1-03-08	3-07-11 1-07-11	88.5 57.83		
	2	T10 Common	10 / 12	17-02-00	9-09-08	2 x 4	1-03-08	3-07-11 1-07-11	170.43 108.33		
	1	T11 Hip	10 / 12	17-02-00	8-10-03	2 x 4	1-03-08	3-07-11 1-07-11	94.93 62.33		
	1 2-ply	T12S Hip Girder	10 / 12	17-02-00	6-10-07	2 x 4 2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	196.82 129.00		
	1	T13 Half Hip	10 / 12	7-03-08	5-00-06	2 x 4	1-03-08	1-07-11 5-00-06	37.77 25.50		
	1	T14 Half Hip	10 / 12	7-03-08	5-10-06	2 x 4	1-03-08	1-07-11 5-10-06	40.81 27.17		

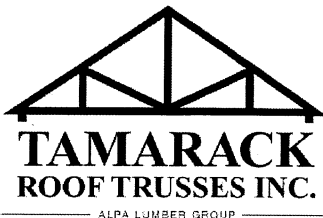DELIVERY SHIPLIST																																	
 TAMARACK ROOF TRUSSES INC. ALPHA LUMBER GROUP	<table><tr><td>Lumber Yard:</td><td>TAMARACK LUMBER</td><td>Job Track:</td><td>51004</td></tr><tr><td>Builder:</td><td>ROYAL PINE HOMES</td><td>PlanLog:</td><td>203048</td></tr><tr><td>Project:</td><td>CENTREFIELD</td><td>Layout ID:</td><td>418938</td></tr><tr><td>Location:</td><td>RICHMOND HILL</td><td>Ref #</td><td></td></tr><tr><td>Model:</td><td>UNIT-4501</td><td>Page:</td><td>2 of 3</td></tr><tr><td>Lot #:</td><td></td><td>Date:</td><td>06-04-2021</td></tr><tr><td>Elevation:</td><td>A-STD.OR 5 BRM</td><td>Designer:</td><td></td></tr><tr><td></td><td></td><td>Sales Rep:</td><td>Mario DiCano</td></tr></table>	Lumber Yard:	TAMARACK LUMBER	Job Track:	51004	Builder:	ROYAL PINE HOMES	PlanLog:	203048	Project:	CENTREFIELD	Layout ID:	418938	Location:	RICHMOND HILL	Ref #		Model:	UNIT-4501	Page:	2 of 3	Lot #:		Date:	06-04-2021	Elevation:	A-STD.OR 5 BRM	Designer:				Sales Rep:	Mario DiCano
Lumber Yard:	TAMARACK LUMBER	Job Track:	51004																														
Builder:	ROYAL PINE HOMES	PlanLog:	203048																														
Project:	CENTREFIELD	Layout ID:	418938																														
Location:	RICHMOND HILL	Ref #																															
Model:	UNIT-4501	Page:	2 of 3																														
Lot #:		Date:	06-04-2021																														
Elevation:	A-STD.OR 5 BRM	Designer:																															
		Sales Rep:	Mario DiCano																														

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	T15S Roof Special	10 / 12	7-08-00	4-10-00	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	87.37 61.33		
	1 2-ply	T16 Jack-Closed Girder	7 / 12	6-10-08	5-03-09	2 x 4 2 x 6		1-03-07 5-03-09	70.65 45.00		
	1 2-ply	JC01 Jack-Closed Girder	10 / 12	3-10-08	6-10-07	2 x 4 2 x 6		3-07-11 6-10-07	53.95 35.67		
	21	J1 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	352.73 224.00		
	6	J2 Jack-Open	7 / 12	6-10-08	5-03-09	2 x 4	1-03-08	1-03-07 5-03-09	118.55 72.00		
	4	J3 Jack-Open	10 / 12	3-10-08	4-10-07	2 x 4	1-03-08	1-07-11 4-10-07	62.29 40.67		
	4	J4 Jack-Open	4 / 12	5-01-08	2-09-11	2 x 4	1-09-08	1-01-03 2-09-11	59.8 40.00		
	6	J5 Jack-Open	4 / 12	4-01-08	2-05-11	2 x 4	1-09-08	1-01-03 2-05-11	75.64 52.00		
	5	J6W Jack-Open	3.5 / 12	5-10-08	2-03-09	2 x 4	1-03-08	7-00 2-03-09	93.6 60.83		
	1	C1 Jack-Open	10 / 12	1-10-15	3-02-13	2 x 4	1-03-08 1-11-09	1-07-11 3-02-13	12.28 8.33		
	1	C2 Jack-Open	10 / 12	1-10-15	3-02-13	2 x 4	1-03-08 1-01	1-07-11 3-02-13	10.14 7.00		

TOTAL # TRUSS= 78


TOTAL BFT OF ALL TRUSSES= 2766.32

BFT.

TOTAL WEIGHT OF ALL TRSSES 4390.41 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
5	Hardware	H2.5T	
1	Hardware	HGUS26-2	
1	Hardware	HUSC26-2	
3	Hardware	LJS26DS	
2	Hardware	LUS24	

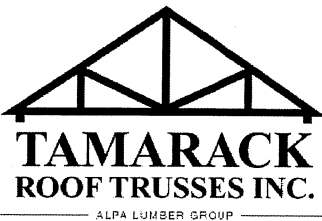DELIVERY SHIPLIST		
	Lumber Yard:	TAMARACK LUMBER
	Builder:	ROYAL PINE HOMES
	Project:	CENTREFIELD
	Location:	RICHMOND HILL
	Model:	UNIT-4501
	Lot #:	
	Elevation:	A-STD.OR 5 BRM
	Job Track:	51004
	PlanLog:	203048
	Layout ID:	418938
	Ref #	
	Page:	3 of 3
	Date:	06-04-2021
	Designer:	
	Sales Rep:	Mario DiCano


HARDWARE


QTY	TYPE	MODEL	LENGTH
-----	------	-------	--------

TOTAL NUMBER OF ITEMS= 12













 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST							
	Lumber Yard: TAMARACK LUMBER						Job Track: 51004	
	Builder: ROYAL PINE HOMES						PlanLog: 203048	
	Project: CENTREFIELD						Layout ID: 410914	
	Location: RICHMOND HILL						Ref #	
	Model: UNIT - 4501						Page: 1 of 3	
Lot #:						Date: 06-04-2021		
Elevation: A -STD. WITH OPT.COFF						Designer:		
						Sales Rep: Mario DiCano		


Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1S Hip Girder	10 / 12	35-10-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	418.24 256.67		
	1	T2 Hip	10 / 12	35-10-00	5-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	148.67 93.50		
	1	T2S Hip	10 / 12	35-10-00	5-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	160.27 102.83		
	1	T3 Hip	10 / 12	35-10-00	6-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	150.15 95.00		
	1	T3S Hip	10 / 12	35-10-00	6-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	169.6 108.83		
	1	T4 Hip	10 / 12	35-10-00	7-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	166.55 103.83		
	1	T4S Hip	10 / 12	35-10-00	7-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	175.9 110.83		
	2	T5 Hip	10 / 12	35-10-00	8-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	329.97 206.00		
	2	T6 Hip	10 / 12	35-10-00	9-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	366.94 228.67		
	2	T7 Hip	10 / 12	35-10-00	10-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	350.64 220.00		
	1 2-ply	T8 Roof Special Girder	10 / 12	35-10-00	5-03-15	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	435.79 262.67		
	1	T9 Hip	10 / 12	17-02-00	8-06-07	2 x 4	1-03-08	3-07-11 1-07-11	88.5 57.83		
	2	T10 Common	10 / 12	17-02-00	9-09-08	2 x 4	1-03-08	3-07-11 1-07-11	170.43 108.33		
	1	T11 Hip	10 / 12	17-02-00	8-10-03	2 x 4	1-03-08	3-07-11 1-07-11	94.93 62.33		

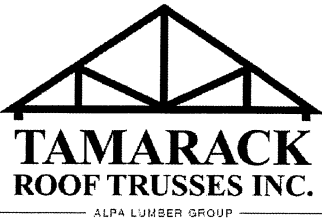
 TAMARACK ROOF TRUSSES INC. ALPHA LUMBER GROUP	DELIVERY SHIPLIST							
	Lumber Yard: TAMARACK LUMBER						Job Track: 51004	
	Builder: ROYAL PINE HOMES						PlanLog: 203048	
	Project: CENTREFIELD						Layout ID: 410914	
	Location: RICHMOND HILL						Ref #	
	Model: UNIT - 4501						Page: 2 of 3	
Lot #:						Date: 06-04-2021		
Elevation: A-STD. WITH OPT.COFF						Designer:		
						Sales Rep: Mario DiCano		

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T12S Hip Girder	10 /12	17-02-00	6-10-07	2 x 4 2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	211.42 135.67		
	1	T13 Half Hip	10 /12	7-03-08	5-00-06	2 x 4	1-03-08	1-07-11 5-00-06	37.77 25.50		
	1	T14 Half Hip	10 /12	7-03-08	5-10-06	2 x 4	1-03-08	1-07-11 5-10-06	40.81 27.17		
	2	T15S Roof Special	10 /12	7-08-00	4-10-00	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	87.35 61.33		
	1 2-ply	T16 Jack-Closed Girder	7 /12	6-10-08	5-03-09	2 x 4 2 x 6		1-03-07 5-03-09	70.65 45.00		
	1 2-ply	JC01 Jack-Closed Girder	10 /12	3-10-08	6-10-07	2 x 4 2 x 6		3-07-11 6-10-07	53.95 35.67		
	13	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	218.35 138.67		
	8	J1S Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 3-01-04	169.99 121.33		
	6	J2 Jack-Open	7 /12	6-10-08	5-03-09	2 x 4	1-03-08	1-03-07 5-03-09	159.83 102.00		
	4	J3 Jack-Open	10 /12	3-10-08	4-10-07	2 x 4	1-03-08	1-07-11 4-10-07	62.29 40.67		
	4	J4 Jack-Open	4 /12	5-01-08	2-09-11	2 x 4	1-09-08	1-01-03 2-09-11	59.8 40.00		
	6	J5 Jack-Open	4 /12	4-01-08	2-05-11	2 x 4	1-09-08	1-01-03 2-05-11	75.64 52.00		
	5	J6W Jack-Open	3.5 /12	5-10-08	2-03-09	2 x 4	1-03-08	7-00 2-03-09	95.26 60.83		
	1	C1 Jack-Open	10 /12	1-10-15	3-02-13	2 x 4	1-03-08 1-11-09	1-07-11 3-02-13	12.28 8.33		

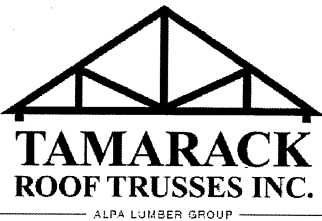 TAMARACK ROOF TRUSSES INC. ALPHA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard: TAMARACK LUMBER Builder: ROYAL PINE HOMES Project: CENTREFIELD Location: RICHMOND HILL Model: UNIT - 4501 Lot #: Elevation: A-STD. WITH OPT.COFF	Job Track: 51004 PlanLog: 203048 Layout ID: 410914 Ref # Page: 3 of 3 Date: 06-04-2021 Designer: Sales Rep: Mario DiCano

Roof Trusses


PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	C2 Jack-Open	10 /12	1-10-15	3-02-13	2 x 4	1-03-08 1-01	1-07-11 3-02-13	10.14 7.00		

TOTAL # TRUSS= 78
TOTAL BFT OF ALL TRUSSES= 2918.49
BFT.
TOTAL WEIGHT OF ALL TRSSES 4592.11
LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	HGUS26-2	
1	Hardware	HUSC26-2	
3	Hardware	LJS26DS	
2	Hardware	LUS24	
5	Hardware	H2.5T	

TOTAL NUMBER OF ITEMS= 12

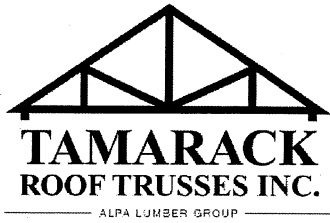


DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: CENTREFIELD
 Location: RICHMOND HILL
 Model: UNIT-4501
 Lot #:
 Elevation: A-5 BRM WITH OPT. COFF

Job Track: 51004
 PlanLog: 203048
 Layout ID: 410915
 Ref #
 Page: 1 of 3
 Date: 06-04-2021
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1S1 Hip Girder	10 / 12	35-10-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	425.75 263.33		
	1	T2 Hip	10 / 12	35-10-00	5-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	148.67 93.50		
	1	T2S1 Hip	10 / 12	35-10-00	5-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	163.9 105.50		
	1	T3 Hip	10 / 12	35-10-00	6-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	150.15 95.00		
	1	T3S1 Hip	10 / 12	35-10-00	6-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	164.21 104.83		
	1	T4 Hip	10 / 12	35-10-00	7-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	163.43 102.17		
	1	T4S1 Hip	10 / 12	35-10-00	7-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	173.36 109.50		
	1	T5 Hip	10 / 12	35-10-00	8-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	161.37 101.00		
	1	T5S1 Hip	10 / 12	35-10-00	8-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	189.13 120.50		
	2	T6 Hip	10 / 12	35-10-00	9-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	366.94 228.67		
	2	T7 Hip	10 / 12	35-10-00	10-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	350.64 220.00		
	1 2-ply	T8 Roof Special Girder	10 / 12	35-10-00	5-03-15	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	394.64 240.00		
	1	T9 Hip	10 / 12	17-02-00	8-06-07	2 x 4	1-03-08	3-07-11 1-07-11	88.5 57.83		
	2	T10 Common	10 / 12	17-02-00	9-09-08	2 x 4	1-03-08	3-07-11 1-07-11	170.43 108.33		

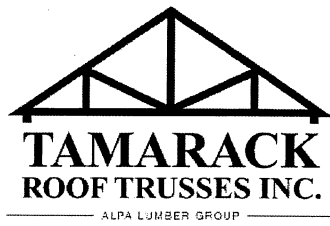


DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: CENTREFIELD
 Location: RICHMOND HILL
 Model: UNIT-4501
 Lot #:
 Elevation: A-5 BRM WITH OPT. COFF



Job Track: 51004
 PlanLog: 203048
 Layout ID: 410915
 Ref #
 Page: 2 of 3
 Date: 06-04-2021
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T11 Hip	10 / 12	17-02-00	8-10-03	2 x 4	1-03-08	3-07-11 1-07-11	94.93 62.33		
	1 2-ply	T12S Hip Girder	10 / 12	17-02-00	6-10-07	2 x 4 2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	196.82 129.00		
	1	T13 Half Hip	10 / 12	7-03-08	5-00-06	2 x 4	1-03-08	1-07-11 5-00-06	37.77 25.50		
	1	T14 Half Hip	10 / 12	7-03-08	5-10-06	2 x 4	1-03-08	1-07-11 5-10-06	40.81 27.17		
	2	T15S Roof Special	10 / 12	7-08-00	4-10-00	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	87.37 61.33		
	1 2-ply	T16 Jack-Closed Girder	7 / 12	6-10-08	5-03-09	2 x 4 2 x 6		1-03-07 5-03-09	70.65 45.00		
	1 2-ply	JC01 Jack-Closed Girder	10 / 12	3-10-08	6-10-07	2 x 4 2 x 6		3-07-11 6-10-07	53.95 35.67		
	16	J1 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	268.74 170.67		
	5	J1S Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 3-01-04	105.09 73.33		
	6	J2 Jack-Open	7 / 12	6-10-08	5-03-09	2 x 4	1-03-08	1-03-07 5-03-09	118.55 72.00		
	4	J3 Jack-Open	10 / 12	3-10-08	4-10-07	2 x 4	1-03-08	1-07-11 4-10-07	62.29 40.67		
	4	J4 Jack-Open	4 / 12	5-01-08	2-09-11	2 x 4	1-09-08	1-01-03 2-09-11	59.8 40.00		
	6	J5 Jack-Open	4 / 12	4-01-08	2-05-11	2 x 4	1-09-08	1-01-03 2-05-11	75.64 52.00		
	5	J6W Jack-Open	3.5 / 12	5-10-08	2-03-09	2 x 4	1-03-08	7-00 2-03-09	93.6 60.83		

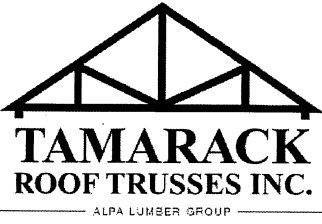 TAMARACK ROOF TRUSSES INC. ALPHA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard: TAMARACK LUMBER Builder: ROYAL PINE HOMES Project: CENTREFIELD Location: RICHMOND HILL Model: UNIT-4501 Lot #: Elevation: A-5 BRM WITH OPT. COFF	Job Track: 51004 PlanLog: 203048 Layout ID: 410915 Ref # Page: 3 of 3 Date: 06-04-2021 Designer: Sales Rep: Mario DiCano

Roof Trusses


PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	C1 Jack-Open	10 /12	1-10-15	3-02-13	2 x 4	1-03-08 1-11-09	1-07-11 3-02-13	12.28 8.33		
	1	C2 Jack-Open	10 /12	1-10-15	3-02-13	2 x 4	1-03-08 1-01	1-07-11 3-02-13	10.14 7.00		

TOTAL # TRUSS= 78
TOTAL BFT OF ALL TRUSSES= 2860.99
BFT.
TOTAL WEIGHT OF ALL TRSSES 4499.58
LBS




HARDWARE


QTY	TYPE	MODEL	LENGTH
5	Hardware	H2.5T	
1	Hardware	HGUS26-2	
1	Hardware	HUSC26-2	
3	Hardware	LJS26DS	
2	Hardware	LUS24	

TOTAL NUMBER OF ITEMS= 12


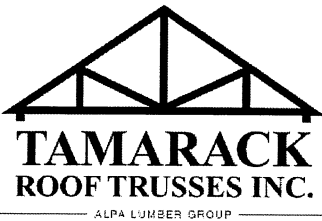
 TAMARACK ROOF TRUSSES INC. ALPHA LUMBER GROUP	DELIVERY SHIPLIST							
	Lumber Yard: TAMARACK LUMBER	Job Track: 51004	PlanLog: 203048 Layout ID: 418939 Ref # Page: 1 of 2 Date: 06-04-2021 Designer: Sales Rep: Mario DiCano					
Builder: ROYAL PINE HOMES								
Project: CENTREFIELD								
Location: RICHMOND HILL								
Model: UNIT-4501								
Lot #:								
Elevation: B-STD.OR 5 BRM								

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	10 / 12	35-10-00	4-01-11	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	371.09 218.00		
	2	T2 Hip	10 / 12	35-10-00	5-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	297.34 187.00		
	2	T3 Hip	10 / 12	35-10-00	6-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	300.3 190.00		
	2	T4 Hip	10 / 12	35-10-00	7-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	326.86 204.33		
	2	T5 Hip	10 / 12	35-10-00	8-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	322.73 202.00		
	2	T6 Hip	10 / 12	35-10-00	9-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	366.94 228.67		
	2	T7 Hip	10 / 12	35-10-00	10-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	350.64 220.00		
	1 2-ply	T8Z Roof Special Girder	10 / 12	35-10-00	5-03-15	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	399.22 242.67		
	1 2-ply	T16Z Jack-Closed Girder	7 / 12	6-10-08	5-03-09	2 x 4 2 x 6		1-03-07 5-03-09	70.65 45.00		
	6	T20 Common	10 / 12	17-02-00	8-09-08	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	504.31 326.00		
	1	T20S Roof Special	10 / 12	17-02-00	8-09-08	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	94.04 62.50		
	1	T21S Roof Special	10 / 12	8-02-00	5-00-08	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	45.53 32.67		
	21	J1 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	352.73 224.00		
	3	J2 Jack-Open	7 / 12	6-10-08	5-03-09	2 x 4	1-03-08	1-03-07 5-03-09	59.27 36.00		

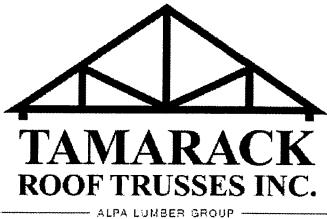 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard: TAMARACK LUMBER Builder: ROYAL PINE HOMES Project: CENTREFIELD Location: RICHMOND HILL Model: UNIT-4501 Lot #: Elevation: B-STD.OR 5 BRM	Job Track: 51004 PlanLog: 203048 Layout ID: 418939 Ref # Page: 2 of 2 Date: 06-04-2021 Designer: Sales Rep: Mario DiCano

Roof Trusses


PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	4	J4 Jack-Open	4 /12	5-01-08	2-09-11	2 x 4	1-09-08	1-01-03 2-09-11	59.8 40.00		
	6	J5 Jack-Open	4 /12	4-01-08	2-05-11	2 x 4	1-09-08	1-01-03 2-05-11	75.64 52.00		

TOTAL # TRUSS= 60
TOTAL BFT OF ALL TRUSSES= 2510.84
BFT.
TOTAL WEIGHT OF ALL TRSSES 3997.1
LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
3	Hardware	LJS26DS	
2	Hardware	LUS26-2	
1	Hardware	HGUS26-2	

TOTAL NUMBER OF ITEMS= 6

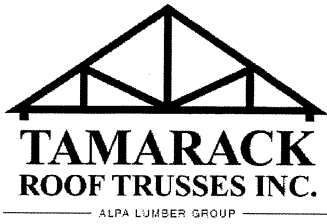



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: CENTREFIELD
 Location: RICHMOND HILL
 Model: UNIT- 4501
 Lot #:
 Elevation: B -STD. WITH OPT.COFF


Job Track: 51004
 PlanLog: 203048
 Layout ID: 410916
 Ref #
 Page: 1 of 2
 Date: 06-04-2021
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1S Hip Girder	10 / 12	35-10-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	388.93 239.00		
	1	T2 Hip	10 / 12	35-10-00	5-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	148.67 93.50		
	1	T2S Hip	10 / 12	35-10-00	5-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	159.87 102.50		
	1	T3 Hip	10 / 12	35-10-00	6-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	150.15 95.00		
	1	T3S Hip	10 / 12	35-10-00	6-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	169.2 108.50		
	1	T4 Hip	10 / 12	35-10-00	7-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	163.43 102.17		
	1	T4S Hip	10 / 12	35-10-00	7-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	169.82 107.33		
	2	T5 Hip	10 / 12	35-10-00	8-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	322.73 202.00		
	2	T6 Hip	10 / 12	35-10-00	9-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	366.94 228.67		
	2	T7 Hip	10 / 12	35-10-00	10-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	350.64 220.00		
	1 2-ply	T8Z Roof Special Girder	10 / 12	35-10-00	5-03-15	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	435.79 262.67		
	1 2-ply	T16Z Jack-Closed Girder	7 / 12	6-10-08	5-03-09	2 x 4 2 x 6		1-03-07 5-03-09	70.65 45.00		
	6	T20 Common	10 / 12	17-02-00	8-09-08	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	504.31 326.00		
	1	T20S Roof Special	10 / 12	17-02-00	8-09-08	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	94.04 62.50		

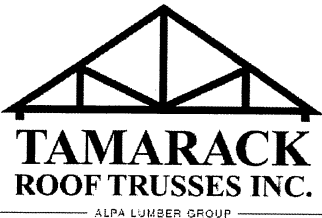 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST			
	Lumber Yard: TAMARACK LUMBER Builder: ROYAL PINE HOMES Project: CENTREFIELD Location: RICHMOND HILL Model: UNIT- 4501 Lot #: Elevation: B -STD. WITH OPT.COFF	Job Track: 51004 PlanLog: 203048 Layout ID: 410916 Ref # Page: 2 of 2 Date: 06-04-2021 Designer: Sales Rep: Mario DiCano		

Roof Trusses


PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T21S Roof Special	10 /12	8-02-00	5-00-08	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	46.08 33.00		
	13	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	218.35 138.67		
	8	J1S Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 3-01-04	169.99 121.33		
	3	J2 Jack-Open	7 /12	6-10-08	5-03-09	2 x 4	1-03-08	1-03-07 5-03-09	59.27 36.00		
	4	J4 Jack-Open	4 /12	5-01-08	2-09-11	2 x 4	1-09-08	1-01-03 2-09-11	59.8 40.00		
	6	J5 Jack-Open	4 /12	4-01-08	2-05-11	2 x 4	1-09-08	1-01-03 2-05-11	75.64 52.00		

TOTAL # TRUSS= 60
 TOTAL BFT OF ALL TRUSSES= 2615.84
 BFT.
 TOTAL WEIGHT OF ALL TRSSES 4124.33
 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	HGUS26-2	
3	Hardware	LJS26DS	
2	Hardware	LUS26-2	

TOTAL NUMBER OF ITEMS= 6

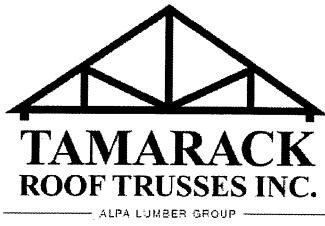


DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: CENTREFIELD
 Location: RICHMOND HILL
 Model: UNIT-4501
 Lot #:
 Elevation: B- 5BR WITH OPT. COFF




Job Track: 51004
 PlanLog: 203048
 Layout ID: 410917
 Ref #
 Page: 1 of 2
 Date: 06-04-2021
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1S1 Hip Girder	10 / 12	35-10-00	4-01-11	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	408.64 249.33		
	1	T2 Hip	10 / 12	35-10-00	5-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	148.67 93.50		
	1	T2S1 Hip	10 / 12	35-10-00	5-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	159.96 103.17		
	1	T3 Hip	10 / 12	35-10-00	6-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	150.15 95.00		
	1	T3S1 Hip	10 / 12	35-10-00	6-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	163.77 104.50		
	1	T4 Hip	10 / 12	35-10-00	7-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	163.43 102.17		
	1	T4S1 Hip	10 / 12	35-10-00	7-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	171.41 108.33		
	1	T5 Hip	10 / 12	35-10-00	8-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	161.37 101.00		
	1	T5S1 Hip	10 / 12	35-10-00	8-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	179.74 115.83		
	2	T6 Hip	10 / 12	35-10-00	9-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	366.94 228.67		
	2	T7 Hip	10 / 12	35-10-00	10-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	350.64 220.00		
	1 2-ply	T8Z Roof Special Girder	10 / 12	35-10-00	5-03-15	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	399.22 242.67		
	1 2-ply	T16Z Jack-Closed Girder	7 / 12	6-10-08	5-03-09	2 x 4 2 x 6		1-03-07 5-03-09	70.65 45.00		
	6	T20 Common	10 / 12	17-02-00	8-09-08	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	504.31 326.00		

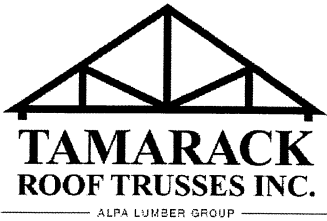 TAMARACK ROOF TRUSSES INC. ALPHA LUMBER GROUP	DELIVERY SHIPLIST				
	Lumber Yard:	TAMARACK LUMBER		Job Track:	51004
	Builder:	ROYAL PINE HOMES		PlanLog:	203048
	Project:	CENTREFIELD		Layout ID:	410917
	Location:	RICHMOND HILL		Ref #	
	Model:	UNIT-4501		Page:	2 of 2
Lot #:			Date:	06-04-2021	
Elevation:	B- 5BR WITH OPT. COFF		Designer:		
			Sales Rep:	Mario DiCano	

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T20S Roof Special	10 /12	17-02-00	8-09-08	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	94.04 62.50		
	1	T21S Roof Special	10 /12	8-02-00	5-00-08	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	45.53 32.67		
	16	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	268.74 170.67		
	5	J1S Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 3-01-04	104.3 73.33		
	3	J2 Jack-Open	7 /12	6-10-08	5-03-09	2 x 4	1-03-08	1-03-07 5-03-09	59.27 36.00		
	4	J4 Jack-Open	4 /12	5-01-08	2-09-11	2 x 4	1-09-08	1-01-03 2-09-11	59.8 40.00		
	6	J5 Jack-Open	4 /12	4-01-08	2-05-11	2 x 4	1-09-08	1-01-03 2-05-11	75.64 52.00		

TOTAL # TRUSS= 60

TOTAL BFT OF ALL TRUSSES= 2602.34


BFT.

TOTAL WEIGHT OF ALL TRSSES 4106.22 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	HGUS26-2	
3	Hardware	LJS26DS	
2	Hardware	LUS26-2	

TOTAL NUMBER OF ITEMS= 6

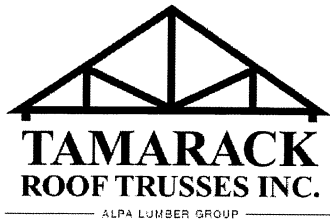


DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: CENTREFIELD
 Location: RICHMOND HILL
 Model: UNIT-4501
 Lot #:
 Elevation: C-STD.OR 5 BRM

Job Track: 51004
 PlanLog: 203048
 Layout ID: 418940
 Ref #
 Page: 1 of 3
 Date: 06-04-2021
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T30 Hip Girder	8 /12	35-10-00	4-01-06	2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	400.68 240.00		
	2	T31 Hip	8 /12	35-10-00	5-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	283.68 177.00		
	2	T32 Hip	8 /12	35-10-00	6-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	306.57 191.33		
	2	T33 Hip	8 /12	35-10-00	7-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	312.92 195.67		
	2	T34 Hip	8 /12	35-10-00	8-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	320.91 196.67		
	2	T35 Hip	8 /12	35-10-00	9-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	333.18 205.00		
	2	T36 Hip	8 /12	35-10-00	10-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	346.88 215.33		
	1 2-ply	T37 Roof Special Girder	8 /12	35-10-00	4-07-06	2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	377.67 229.00		
	1	T38 Hip	8 /12	17-02-00	6-07-13	2 x 4	1-03-08	1-04-13 2-10-13	76.93 49.00		
	2	T39 Common	8 /12	17-02-00	7-10-08	2 x 4	1-03-08	1-04-13 2-10-13	156.74 102.33		
	1 2-ply	T40 Hip Girder	8 /12	17-02-00	5-03-13	2 x 4 2 x 6	1-03-08	1-04-13 2-10-13	179.3 112.67		
	1	T41 Common	8 /12	8-08-00	5-09-08	2 x 4	1-03-08 1-03-08	2-10-13 2-10-13	43.09 27.33		
	1	T42 Hip Girder	8 /12	8-08-00	5-05-13	2 x 4 2 x 6	1-03-08 1-03-08	2-10-13 2-10-13	51.41 34.00		
	2	T43S Half Hip Girder	8 /12	3-10-08	4-01-13	2 x 4	1-03-08	1-04-13 4-01-13	55.74 38.67		

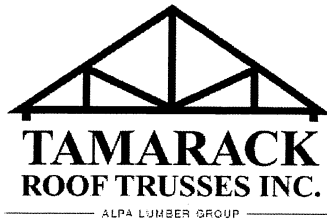

DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: CENTREFIELD
 Location: RICHMOND HILL
 Model: UNIT-4501
 Lot #:
 Elevation: C-STD.OR 5 BRM

Job Track: 51004
 PlanLog: 203048
 Layout ID: 418940
 Ref #
 Page: 2 of 3
 Date: 06-04-2021
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses


PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	T44S Jack-Closed	8 /12	3-10-08	5-05-13	2 x 4	1-03-08	1-04-13 5-05-13	58.8 40.33		
	1 2-ply	T45 Jack-Closed Girder	8 /12	5-10-08	5-03-13	2 x 4 2 x 6		1-04-13 5-03-13	64.23 40.67		
	1 2-ply	T46 Jack-Closed Girder	6 /12	6-10-08	4-07-04	2 x 4 2 x 6		1-02-00 4-07-04	67.02 42.33		
	21	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	352.73 224.00		
	4	J4 Jack-Open	4 /12	5-01-08	2-09-11	2 x 4	1-09-08	1-01-03 2-09-11	59.8 40.00		
	6	J5 Jack-Open	4 /12	4-01-08	2-05-11	2 x 4	1-09-08	1-01-03 2-05-11	75.64 52.00		
	6	J30 Jack-Open	6 /12	6-10-08	4-07-04	2 x 4	1-03-08	1-02-00 4-07-04	115.26 72.00		
	2	J32 Jack-Open	8 /12	1-10-08	2-07-13	2 x 4	1-03-08	1-04-13 2-07-13	18.18 11.33		
	2	J33 Jack-Open	8 /12	5-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	39.15 24.33		
	1	C30 Jack-Open	8 /12	3-10-15	4-00-02	2 x 4	1-03-08 1-11-09	1-04-13 4-00-02	16.88 10.83		
	1	C31 Jack-Open	8 /12	1-10-15	2-08-02	2 x 4	1-03-08 3-11-09	1-04-13 2-08-02	13.73 9.00		
	1	C32 Jack-Open	8 /12	2-00-00	4-00-02	2 x 4	1-03-08 1-10-15	1-04-13 2-08-13	12.31 7.67		
	1	C33 Jack-Open	8 /12	1-10-15	2-08-02	2 x 4	1-03-08 1-01	1-04-13 2-08-02	9.57 6.33		

TOTAL # TRUSS= 76

TOTAL BFT OF ALL TRUSSES= 2594.82

BFT.


TOTAL WEIGHT OF ALL TRSSES 4148.98 LBS

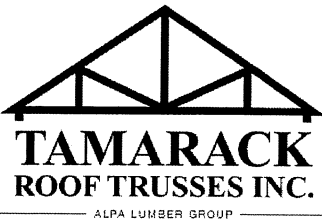	DELIVERY SHIPLIST	
	Lumber Yard:	TAMARACK LUMBER
	Builder:	ROYAL PINE HOMES
	Project:	CENTREFIELD
	Location:	RICHMOND HILL
	Model:	UNIT-4501
	Lot #:	
Elevation:	C-STD.OR 5 BRM	
Job Track:	51004	
PlanLog:	203048	
Layout ID:	418940	
Ref #		
Page:	3 of 3	
Date:	06-04-2021	
Designer:		
Sales Rep:	Mario DiCano	

HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	HGUS26-2	
4	Hardware	LJS26DS	
5	Hardware	LUS24	
1	Hardware	LUS26-2	

TOTAL NUMBER OF ITEMS= 11

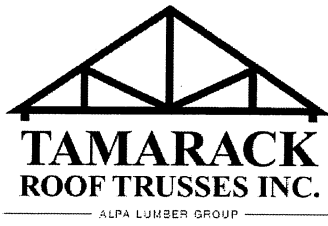


DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: CENTREFIELD
 Location: RICHMOND HILL
 Model: UNIT-4501
 Lot #:
 Elevation: C -STD. WITH OPT.COFF












Job Track: 51004
 PlanLog: 203048
 Layout ID: 410918
 Ref #
 Page: 1 of 3
 Date: 06-04-2021
 Designer:
 Sales Rep: Mario DiCano


Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T30S Hip Girder	8 /12	35-10-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	378.99 232.00		
	1	T31 Hip	8 /12	35-10-00	5-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	141.84 88.50		
	1	T31S Hip	8 /12	35-10-00	5-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	159.28 101.17		
	1	T32 Hip	8 /12	35-10-00	6-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	153.29 95.67		
	1	T32S Hip	8 /12	35-10-00	6-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	159.74 101.17		
	1	T33 Hip	8 /12	35-10-00	7-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	156.46 97.83		
	1	T33S Hip	8 /12	35-10-00	7-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	171.33 109.00		
	2	T34 Hip	8 /12	35-10-00	8-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	320.91 196.67		
	2	T35 Hip	8 /12	35-10-00	9-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	333.18 205.00		
	2	T36 Hip	8 /12	35-10-00	10-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	346.88 215.33		
	1 2-ply	T37 Roof Special Girder	8 /12	35-10-00	4-07-06	2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	414.51 246.67		
	1	T38 Hip	8 /12	17-02-00	6-07-13	2 x 4	1-03-08	1-04-13 2-10-13	76.93 49.00		
	2	T39 Common	8 /12	17-02-00	7-10-08	2 x 4	1-03-08	1-04-13 2-10-13	156.74 102.33		
	1 2-ply	T40 Hip Girder	8 /12	17-02-00	5-03-13	2 x 4 2 x 6	1-03-08	1-04-13 2-10-13	179.3 112.67		



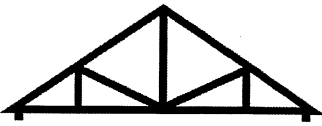
 TAMARACK ROOF TRUSSES INC. ALPHA LUMBER GROUP	DELIVERY SHIPLIST					Lumber Yard: TAMARACK LUMBER Builder: ROYAL PINE HOMES Project: CENTREFIELD Location: RICHMOND HILL Model: UNIT-4501 Lot #: Elevation: C -STD. WITH OPT.COFF		Job Track: 51004 PlanLog: 203048 Layout ID: 410918 Ref # Page: 2 of 3 Date: 06-04-2021 Designer: Sales Rep: Mario DiCano	
---	--------------------------	--	--	--	--	--	--	---	--

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T41 Common	8 /12	8-08-00	5-09-08	2 x 4	1-03-08 1-03-08	2-10-13 2-10-13	43.09 27.33		
	1	T42 Hip Girder	8 /12	8-08-00	5-05-13	2 x 4 2 x 6	1-03-08 1-03-08	2-10-13 2-10-13	51.41 34.00		
	2	T43S Half Hip Girder	8 /12	3-10-08	4-01-13	2 x 4	1-03-08	1-04-13 4-01-13	55.74 38.67		
	2	T44S Jack-Closed	8 /12	3-10-08	5-05-13	2 x 4	1-03-08	1-04-13 5-05-13	58.9 40.33		
	1 2-ply	T45 Jack-Closed Girder	8 /12	5-10-08	5-03-13	2 x 4 2 x 6		1-04-13 5-03-13	64.23 40.67		
	1 2-ply	T46 Jack-Closed Girder	6 /12	6-10-08	4-07-04	2 x 4 2 x 6		1-02-00 4-07-04	67.02 42.33		
	13	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	218.35 138.67		
	8	J1S Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 3-01-04	169.99 121.33		
	4	J4 Jack-Open	4 /12	5-01-08	2-09-11	2 x 4	1-09-08	1-01-03 2-09-11	59.8 40.00		
	6	J5 Jack-Open	4 /12	4-01-08	2-05-11	2 x 4	1-09-08	1-01-03 2-05-11	75.64 52.00		
	6	J30 Jack-Open	6 /12	6-10-08	4-07-04	2 x 4	1-03-08	1-02-00 4-07-04	115.26 72.00		
	2	J32 Jack-Open	8 /12	1-10-08	2-07-13	2 x 4	1-03-08	1-04-13 2-07-13	18.18 11.33		
	2	J33 Jack-Open	8 /12	5-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	39.15 24.33		
	1	C30 Jack-Open	8 /12	3-10-15	4-00-02	2 x 4	1-03-08 1-11-09	1-04-13 4-00-02	16.88 10.83		

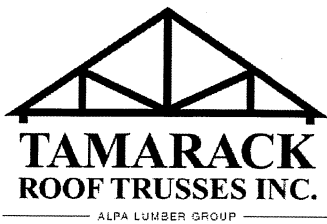 TAMARACK ROOF TRUSSES INC. ALPHA LUMBER GROUP	DELIVERY SHIPLIST			
	Lumber Yard:	TAMARACK LUMBER	Job Track:	51004
	Builder:	ROYAL PINE HOMES	PlanLog:	203048
	Project:	CENTREFIELD	Layout ID:	410918
	Location:	RICHMOND HILL	Ref #	
	Model:	UNIT-4501	Page:	3 of 3
Lot #:		Date:	06-04-2021	
Elevation:	C -STD. WITH OPT.COFF	Designer:		
		Sales Rep:	Mario DiCano	

Roof Trusses


PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	C31 Jack-Open	8 /12	1-10-15	2-08-02	2 x 4	1-03-08 3-11-09	1-04-13 2-08-02	13.73 9.00		
	1	C32 Jack-Open	8 /12	2-00-00	4-00-02	2 x 4	1-03-08 1-10-15	1-04-13 2-08-13	12.31 7.67		
	1	C33 Jack-Open	8 /12	1-10-15	2-08-02	2 x 4	1-03-08 1-01	1-04-13 2-08-02	9.57 6.33		

TOTAL # TRUSS= 76 TOTAL BFT OF ALL TRUSSES= 2669.83 BFT. TOTAL WEIGHT OF ALL TRSSES 4238.62 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	HGUS26-2	
4	Hardware	LJS26DS	
5	Hardware	LUS24	
1	Hardware	LUS26-2	

TOTAL NUMBER OF ITEMS= 11

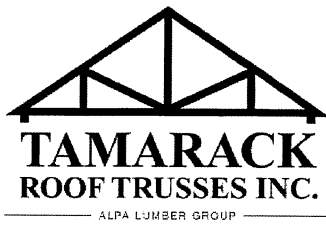


DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: CENTREFIELD
 Location: RICHMOND HILL
 Model: UNIT-4501
 Lot #:
 Elevation: C- 5 BRM. WITH OPT. COFF

Job Track: 51004
 PlanLog: 203048
 Layout ID: 410919
 Ref #
 Page: 1 of 3
 Date: 06-04-2021
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T30S1 Hip Girder	8 /12	35-10-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	416.31 259.33		
	1	T31 Hip	8 /12	35-10-00	5-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	141.84 88.50		
	1	T31S1 Hip	8 /12	35-10-00	5-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	154.18 97.00		
	1	T32 Hip	8 /12	35-10-00	6-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	153.29 95.67		
	1	T32S1 Hip	8 /12	35-10-00	6-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	162.86 102.67		
	1	T33 Hip	8 /12	35-10-00	7-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	156.46 97.83		
	1	T33S1 Hip	8 /12	35-10-00	7-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	173.36 110.50		
	1	T34 Hip	8 /12	35-10-00	8-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	160.45 98.33		
	1	T34S1 Hip	8 /12	35-10-00	8-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	180.97 113.00		
	2	T35 Hip	8 /12	35-10-00	9-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	333.18 205.00		
	2	T36 Hip	8 /12	35-10-00	10-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	346.88 215.33		
	1 2-ply	T37 Roof Special Girder	8 /12	35-10-00	4-07-06	2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	377.67 229.00		
	1	T38 Hip	8 /12	17-02-00	6-07-13	2 x 4	1-03-08	1-04-13 2-10-13	76.93 49.00		
	2	T39 Common	8 /12	17-02-00	7-10-08	2 x 4	1-03-08	1-04-13 2-10-13	156.74 102.33		

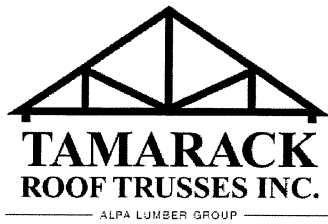

DELIVERY SHIPLIST


Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: CENTREFIELD
 Location: RICHMOND HILL
 Model: UNIT-4501

Lot #:
 Elevation: C- 5 BRM. WITH OPT. COFF




Job Track: 51004
 PlanLog: 203048
 Layout ID: 410919
 Ref #
 Page: 2 of 3
 Date: 06-04-2021
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T40 Hip Girder	8 /12	17-02-00	5-03-13	2 x 4 2 x 6	1-03-08	1-04-13 2-10-13	179.3 112.67		
	1	T41 Common	8 /12	8-08-00	5-09-08	2 x 4	1-03-08 1-03-08	2-10-13 2-10-13	43.09 27.33		
	1	T42 Hip Girder	8 /12	8-08-00	5-05-13	2 x 4 2 x 6	1-03-08 1-03-08	2-10-13 2-10-13	51.41 34.00		
	2	T43S Half Hip Girder	8 /12	3-10-08	4-01-13	2 x 4	1-03-08	1-04-13 4-01-13	55.74 38.67		
	2	T44S Jack-Closed	8 /12	3-10-08	5-05-13	2 x 4	1-03-08	1-04-13 5-05-13	58.8 40.33		
	1 2-ply	T45 Jack-Closed Girder	8 /12	5-10-08	5-03-13	2 x 4 2 x 6		1-04-13 5-03-13	64.23 40.67		
	1 2-ply	T46 Jack-Closed Girder	6 /12	6-10-08	4-07-04	2 x 4 2 x 6		1-02-00 4-07-04	67.02 42.33		
	16	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	268.74 170.67		
	5	J1S Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 3-01-04	104.27 73.33		
	4	J4 Jack-Open	4 /12	5-01-08	2-09-11	2 x 4	1-09-08	1-01-03 2-09-11	59.8 40.00		
	6	J5 Jack-Open	4 /12	4-01-08	2-05-11	2 x 4	1-09-08	1-01-03 2-05-11	75.64 52.00		
	6	J30 Jack-Open	6 /12	6-10-08	4-07-04	2 x 4	1-03-08	1-02-00 4-07-04	115.26 72.00		
	2	J32 Jack-Open	8 /12	1-10-08	2-07-13	2 x 4	1-03-08	1-04-13 2-07-13	18.18 11.33		
	2	J33 Jack-Open	8 /12	5-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	39.15 24.33		

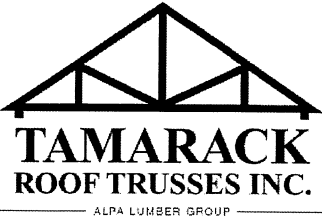 TAMARACK ROOF TRUSSES INC. ALPHA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard: TAMARACK LUMBER Builder: ROYAL PINE HOMES Project: CENTREFIELD Location: RICHMOND HILL Model: UNIT-4501 Lot #: Elevation: C- 5 BRM. WITH OPT. COFF	Job Track: 51004 PlanLog: 203048 Layout ID: 410919 Ref # Page: 3 of 3 Date: 06-04-2021 Designer: Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	C30 Jack-Open	8 /12	3-10-15	4-00-02	2 x 4	1-03-08 1-11-09	1-04-13 4-00-02	16.88 10.83		
	1	C31 Jack-Open	8 /12	1-10-15	2-08-02	2 x 4	1-03-08 3-11-09	1-04-13 2-08-02	13.73 9.00		
	1	C32 Jack-Open	8 /12	2-00-00	4-00-02	2 x 4	1-03-08 1-10-15	1-04-13 2-08-13	12.31 7.67		
	1	C33 Jack-Open	8 /12	1-10-15	2-08-02	2 x 4	1-03-08 1-01	1-04-13 2-08-02	9.57 6.33		

TOTAL # TRUSS= 76
 TOTAL BFT OF ALL TRUSSES= 2676.98
 BFT.
 TOTAL WEIGHT OF ALL TRSSES 4244.21 LBS

HARDWARE


QTY	TYPE	MODEL	LENGTH
1	Hardware	HGUS26-2	
4	Hardware	LJS26DS	
5	Hardware	LUS24	
1	Hardware	LUS26-2	

TOTAL NUMBER OF ITEMS= 11

JOB NAME 418938	TRUSS NAME T1	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
---------------------------	-------------------------	----------------------	-----------------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 15:24:14 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wlmz?k45-7owW0PrdY4srsDWb4jfhKsgOpw_dxqA7WqQZbEFQV

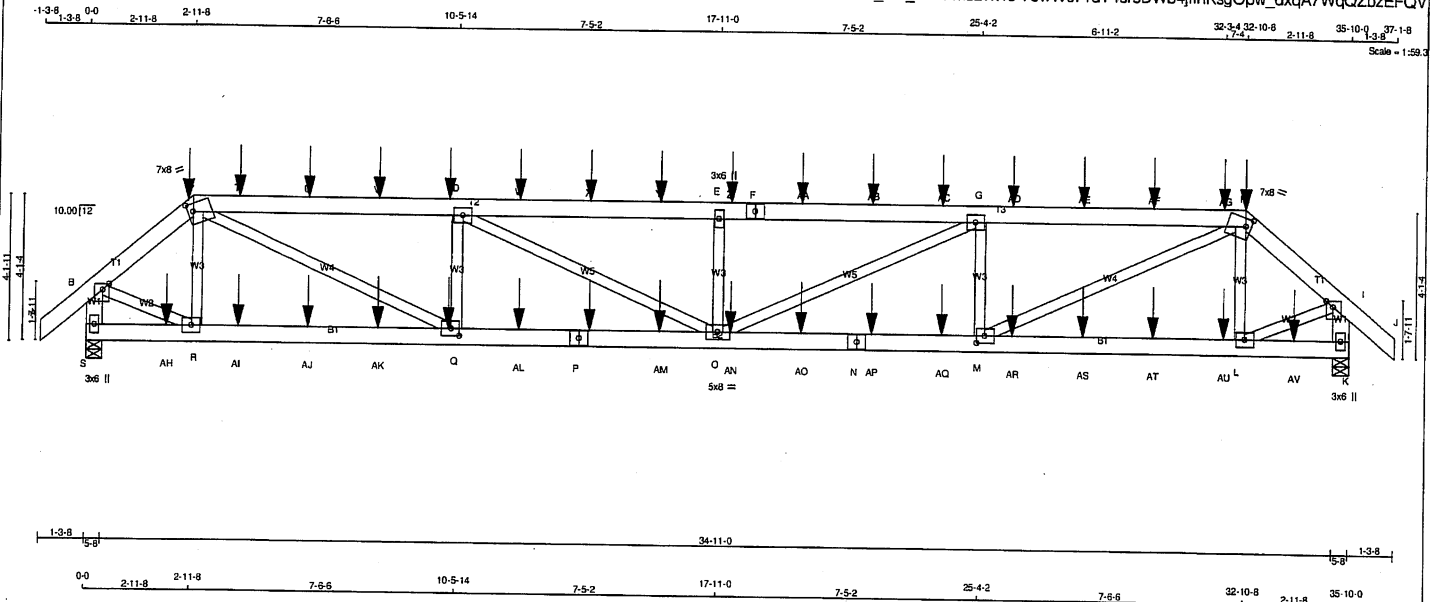

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x6	DRY No.2	SPF
C - F	2x6	DRY No.2	SPF
F - H	2x6	DRY No.2	SPF
H - J	2x6	DRY No.2	SPF
J - S	2x6	DRY No.2	SPF
S - B	2x6	DRY No.2	SPF
B - I	2x6	DRY No.2	SPF
I - P	2x6	DRY No.2	SPF
P - N	2x6	DRY No.2	SPF
N - K	2x6	DRY No.2	SPF
ALL WEBS EXCEPT	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	2	12
C - F	2	12
F - H	2	12
H - J	2	12
J - S	2	12
S - B	2	12
B - I	2	12
I - P	2	12
P - N	2	12
N - K	2	12
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
A - P	2	12
P - N	2	12
N - K	2	12
WEBS : (0.122"x3") SPIRAL NAILS		
2x4	1	6

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
JT	VERT	DOWN	HORZ	DOWN	HORZ	UP	IN-SX	DOWN	IN-SX
S	3368	0	0	3368	0	0	5-8	5-8	5-8
K	3426	0	0	3426	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	2381	1571 / 0	0 / 0	0 / 0	0 / 0	810 / 0	0 / 0
K	2421	1598 / 0	0 / 0	0 / 0	0 / 0	823 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.88 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0 / 42	A-B	-687 / 0
B-C	-3399 / 0	C-Q	0 / 4746
C-T	-6847 / 0	Q-D	-1843 / 0
T-U	-6847 / 0	D-O	0 / 1436
U-V	-6847 / 0	O-E	-1013 / 0
V-D	-6847 / 0	E-G	0 / 1412
D-W	-8136 / 0	G-H	-1834 / 0
W-X	-8136 / 0	H-I	0 / 4722
X-Y	-8136 / 0	I-L	-698 / 0
Y-E	-8136 / 0	B-R	0 / 2758
E-Z	-8136 / 0	L-I	0 / 2803
Z-F	-8136 / 0		
F-AA	-8136 / 0		
AA-AB	-8136 / 0		
AB-AC	-8136 / 0		
AC-G	-8136 / 0		
G-AD	-6888 / 0		
AD-AE	-6888 / 0		
AE-AF	-6888 / 0		
AF-AG	-6888 / 0		
AG-H	-6888 / 0		
H-I	-3455 / 0		
I-J	0 / 42		
J-S	-3392 / 0		
S-B	-3444 / 0		
B-K	-3444 / 0		

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.20")
ALLOWABLE DEFL.(TL) = L/360 (1.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.38")

CSI: TC=0.46/1.00 (E-G:1), BC=0.52/1.00 (O-Q:1), WB=0.42/1.00 (Q-Q:1), SS=0.22/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (O) (INPUT = 0.90)
JSI METAL= 0.67 (P) (INPUT = 1.00)

CONTINUED ON PAGE 2



Structural component only
DWG# T-2115252

JOB NAME 418938	TRUSS NAME T1	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
---------------------------	-------------------------	----------------------	-----------------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 15:24:14 2021 Page 2
ID:GzzEEXDtkQt BH M?wimsz?k45-7owW0PrdY4srsDWb4jfhKsqOow dxqA7WgQZbzEFQV

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	2.00	2.25
C	TTWW-m	MT20	7.0	8.0	2.75	1.75
D	TMVW-t	MT20	5.0	6.0		
E	TMVW-w	MT20	3.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMVW-t	MT20	5.0	6.0		
H	TTWW-m	MT20	7.0	8.0	2.75	1.75
I	TMVW+p	MT20	5.0	6.0	2.00	2.25
K	BMV1+p	MT20	3.0	6.0		
L	BMVW-t	MT20	5.0	6.0		
M	BMVW-t	MT20	5.0	6.0	2.50	2.75
N	BS-t	MT20	5.0	6.0		
O	BMVWW-t	MT20	5.0	8.0		
P	BS-t	MT20	5.0	6.0		
Q	BMVW-t	MT20	5.0	6.0	2.50	2.75
R	BMVW-t	MT20	5.0	6.0		
S	BMV1+p	MT20	3.0	6.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (LC)	MAX. UNBRAC (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRAC (LC)
FR-TO		FROM	TO	LENGTH	FR-TO		
AR-AS	0 / 2610	-18.5	-18.5	0.24 (1)	10.00		
AS-AT	0 / 2610	-18.5	-18.5	0.24 (1)	10.00		
AT-AU	0 / 2610	-18.5	-18.5	0.24 (1)	10.00		
AU-L	0 / 2610	-18.5	-18.5	0.24 (1)	10.00		
L-AV	0 / 0	-18.5	-18.5	0.08 (4)	10.00		
AV-K	0 / 0	-18.5	-18.5	0.08 (4)	10.00		

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	2-11-8	-30	-30	---	FRONT	VERT	DEAD	---	C1
C	2-11-8	-127	-127	---	FRONT	VERT	SNOW	---	C1
D	10-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
H	32-10-8	-30	-30	---	FRONT	VERT	DEAD	---	C1
H	32-10-8	-127	-127	---	FRONT	VERT	SNOW	---	C1
P	14-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
Q	10-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
T	4-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
U	6-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
V	8-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
W	12-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
X	14-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
Y	16-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
Z	18-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AA	20-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AB	22-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AC	24-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AD	26-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AE	28-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AF	30-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AG	32-3-4	-89	-89	---	FRONT	VERT	TOTAL	---	C1
AH	2-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AI	4-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AJ	6-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AK	8-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AL	12-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AM	16-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AN	18-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AO	20-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AP	22-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AQ	24-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AR	26-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AS	28-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AT	30-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AU	32-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AV	34-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


1) -C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2115252

JOB NAME 410914	TRUSS NAME T1S	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 13:22:10 2021 Page 1	

ID:GzzEEEDtfrQt_BH_M?wlmssz?k45-ZmNkt4DXMn61Cgcz1YGFsrX0?TAicTj8_2itV5zEHCx

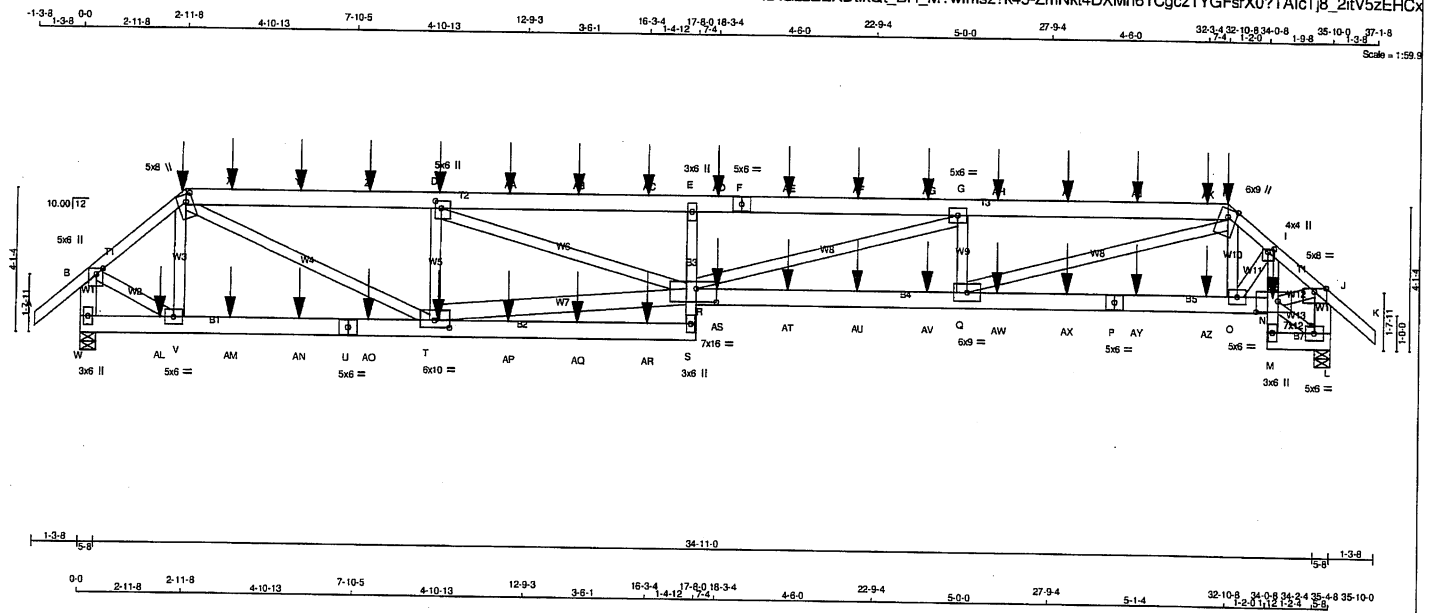

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - F	2x6	DRY	No.2
F - H	2x6	DRY	No.2
H - K	2x4	DRY	No.2
W - B	2x6	DRY	No.2
L - J	2x6	DRY	No.2
W - U	2x6	DRY	No.2
U - S	2x6	DRY	No.2
S - E	2x4	DRY	No.2
R - P	2x6	DRY	No.2
P - N	2x6	DRY	No.2
M - I	2x4	DRY	No.2
M - L	2x6	DRY	No.2
ALL WEBS	2x4	DRY	No.2
EXCEPT	T - R	2x6	DRY

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A - C	12	SIDE(61.0)
H - K	12	SIDE(61.0)
C - F	12	SIDE(163.1)
F - H	12	SIDE(61.0)
W - B	12	TOP
L - J	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
W - U	12	SIDE(0.0)
U - S	12	SIDE(163.1)
R - P	12	SIDE(0.0)
P - N	12	SIDE(61.0)
M - L	12	TOP
S - E	12	TOP
I - M	12	TOP
WEBS: (0.122"x3") SPIRAL NAILS		
2x4	6	
2x6	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT REQRD
W	3511	0	BRG
L	3784	0	BRG

UNFACTORED REACTIONS						
JT	1ST LCASE	MAX / MIN COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
W	2481	1637 / 0	0 / 0	0 / 0	844 / 0	0 / 0
L	2674	1763 / 0	0 / 0	0 / 0	912 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) W, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.12 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LENGTH (FT)
FR-TO			
A-B	0 / 41	-91.8	10.00
B-C	-3361 / 0	-91.8	5.00
C-X	-7047 / 0	-91.8	4.16
X-Y	-7047 / 0	-91.8	4.16
Y-Z	-7047 / 0	-91.8	4.16
Z-D	-7047 / 0	-91.8	4.16
D-AA	-11930 / 0	-91.8	3.12
AA-AB	-11930 / 0	-91.8	3.12
AB-AC	-11930 / 0	-91.8	3.12
AC-E	-11930 / 0	-91.8	3.12
E-AD	-12084 / 0	-91.8	3.14
AD-F	-12084 / 0	-91.8	3.14
F-AE	-12084 / 0	-91.8	3.14
AE-AF	-12084 / 0	-91.8	3.14
AF-AG	-12084 / 0	-91.8	3.14
AG-G	-10505 / 0	-91.8	3.40
G-AH	-10505 / 0	-91.8	3.40
AH-AI	-10505 / 0	-91.8	3.40
AI-AJ	-10505 / 0	-91.8	3.40
AJ-AK	-10505 / 0	-91.8	3.40
AK-H	-10505 / 0	-91.8	3.40
H-I	-5128 / 0	-91.8	4.17
I-J	-4778 / 0	-91.8	4.30
J-K	0 / 41	-91.8	10.00
W-B	-3530 / 0	0.0	7.45
L-J	-3702 / 0	0.0	7.32

WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LENGTH (FT)
FR-TO			
V-C	-912 / 0	0.08	10.00
C-T	0 / 4965	0.44	5.00
T-D	-2974 / 0	0.25	4.16
D-R	0 / 6844	0.44	4.16
R-Q	0 / 5037	0.45	4.16
Q-H	0 / 1668	0.15	3.12
H-G	-1792 / 0	0.12	3.12
G-H	0 / 6906	0.61	3.12
H-O	0 / 182	0.02	3.12
O-I	0 / 518	0.05	3.12
I-V	0 / 2825	0.25	3.14
V-N	-124 / 0	0.01	3.14
N-J	0 / 3641	0.32	3.14

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDTL. USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.38")
ALLOWABLE DEFL.(TL) = L/360 (1.19")
CALCULATED VERT. DEFL.(TL) = L/599 (0.72")

CSI: TC=0.63/1.00 (D-E:1), BC=0.85/1.00 (Q-R:1), WB=0.61/1.00 (H-Q:1), SS=0.21/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.



Structural component only
DWG# T-2115214

JOB NAME 410914	TRUSS NAME T1S	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	---	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri May 21 13:22:10 2021 Page 2
ID:GzzEEEDtfrkQt BH M?wmsz?k45-ZmNkt4DXMn61Cqcz1YGFsrX0?TAIcTj8 2itV5zEHCx

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	2.00	2.25
C	TTWW+m	MT20	5.0	8.0	2.50	2.25
D	TMVW+t	MT20	5.0	6.0	2.50	2.00
E	TMV+p	MT20	3.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMVW-t	MT20	5.0	6.0		
H	TTWW+m	MT20	6.0	9.0	Edge	
I	TMVW+p	MT20	4.0	4.0	1.00	2.00
J	TMVW-p	MT20	5.0	8.0	Edge	
L	BMVW1-t	MT20	5.0	6.0		
M	BMV+p	MT20	3.0	6.0		
N	BMVWV-I	MT20	7.0	12.0	3.75	7.50
O	BMVW-t	MT20	5.0	6.0		
P	BS-t	MT20	5.0	6.0		
Q	BMVW-t	MT20	6.0	9.0		
R	BMVWVW-I	MT20	7.0	16.0	4.50	7.00
S	BMV+p	MT20	3.0	6.0		
T	BMVWVW-t	MT20	6.0	10.0	2.50	5.00
U	BS-t	MT20	5.0	6.0		
V	BMVW-t	MT20	5.0	6.0		
W	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED UNBRAC LENGTH FR-TO	MAX CSI (LC)
FR-TO		FROM TO					
AU-AV	0 / 10505	-18.5	-18.5 0.85 (1)			10.00	
AV-Q	0 / 10505	-18.5	-18.5 0.85 (1)			10.00	
Q-AW	0 / 3988	-18.5	-18.5 0.44 (1)			10.00	
AW-AX	0 / 3988	-18.5	-18.5 0.44 (1)			10.00	
AX-P	0 / 3988	-18.5	-18.5 0.44 (1)			10.00	
P-AY	0 / 3988	-18.5	-18.5 0.44 (1)			10.00	
AY-AZ	0 / 3988	-18.5	-18.5 0.44 (1)			10.00	
AZ-O	0 / 3988	-18.5	-18.5 0.44 (1)			10.00	
O-N	0 / 3678	-18.5	-18.5 0.42 (1)			10.00	
M-N	0 / 17	0.0	0.0 0.08 (1)			10.00	
N-I	-847 / 0	0.0	0.0 0.08 (1)			7.81	
M-L	0 / 105	-18.5	-18.5 0.01 (1)			10.00	

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	2-11-8	-30	-30		FRONT	VERT	DEAD		C1
C	2-11-8	-127	-127		FRONT	VERT	SNOW		C1
D	10-3-4	-76	-76		FRONT	VERT	TOTAL		C1
H	32-10-8	-30	-30		FRONT	VERT	DEAD		C1
H	32-10-8	-127	-127		FRONT	VERT	SNOW		C1
N	34-2-4	-28	-28		FRONT	VERT	TOTAL		C1
T	10-3-4	-21	-21		FRONT	VERT	TOTAL		C1
X	4-3-4	-76	-76		FRONT	VERT	TOTAL		C1
Y	6-3-4	-76	-76		FRONT	VERT	TOTAL		C1
Z	8-3-4	-76	-76		FRONT	VERT	TOTAL		C1
AA	12-3-4	-76	-76		FRONT	VERT	TOTAL		C1
AB	14-3-4	-76	-76		FRONT	VERT	TOTAL		C1
AC	16-3-4	-76	-76		FRONT	VERT	TOTAL		C1
AD	18-3-4	-70	-70		FRONT	VERT	TOTAL		C1
AE	20-3-4	-70	-70		FRONT	VERT	TOTAL		C1
AF	22-3-4	-70	-70		FRONT	VERT	TOTAL		C1
AG	24-3-4	-70	-70		FRONT	VERT	TOTAL		C1
AH	26-3-4	-70	-70		FRONT	VERT	TOTAL		C1
AI	28-3-4	-70	-70		FRONT	VERT	TOTAL		C1
AJ	30-3-4	-70	-70		FRONT	VERT	TOTAL		C1
AK	32-3-4	-82	-82		FRONT	VERT	TOTAL		C1
AL	2-3-4	-21	-21		FRONT	VERT	TOTAL		C1
AM	4-3-4	-21	-21		FRONT	VERT	TOTAL		C1
AN	6-3-4	-21	-21		FRONT	VERT	TOTAL		C1
AO	8-3-4	-21	-21		FRONT	VERT	TOTAL		C1
AP	12-3-4	-21	-21		FRONT	VERT	TOTAL		C1
AQ	14-3-4	-21	-21		FRONT	VERT	TOTAL		C1
AR	16-3-4	-21	-21		FRONT	VERT	TOTAL		C1
AS	18-3-4	-73	-73		FRONT	VERT	TOTAL		C1
AT	20-3-4	-71	-71		FRONT	VERT	TOTAL		C1
AU	22-3-4	-71	-71		FRONT	VERT	TOTAL		C1
AV	24-3-4	-71	-71		FRONT	VERT	TOTAL		C1
AW	26-3-4	-71	-71		FRONT	VERT	TOTAL		C1
AX	28-3-4	-71	-71		FRONT	VERT	TOTAL		C1
AY	30-3-4	-71	-71		FRONT	VERT	TOTAL		C1
AZ	32-3-4	-71	-71		FRONT	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

JSI GRIP= 0.90 (D) (INPUT = 0.90)
JSI METAL= 0.86 (D) (INPUT = 1.00)



Structural component only
DWG# T-2115214

CONTINUED ON PAGE 2

JOB NAME 410915	TRUSS NAME T1S1	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 14:32:54 2021 Page 2	

ID:GzzEEXDtKt BH M?wlmSz?k45-IFp8bFaeulpsMt3eesPUspJofIH wdpukIST6zEGAd

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	5.0	6.0	2.00	2.25
C TTWW+m	MT20	5.0	8.0	2.50	2.25
D, E, H					
D TMVW-t	MT20	5.0	6.0		
F TS-t	MT20	5.0	6.0		
G TMV+p	MT20	3.0	6.0		
I TTWW+m	MT20	6.0	9.0	Edge	
J TMVW+p	MT20	4.0	4.0	1.00	2.00
K TMVW-p	MT20	5.0	8.0	Edge	
M BMVW-t	MT20	5.0	6.0		
N BMV+p	MT20	3.0	6.0		
O BVMWV-t	MT20	6.0	12.0	3.25	7.50
P BVMWV-t	MT20	5.0	6.0		
Q BVMWV-t	MT20	5.0	6.0	2.50	2.50
R BVMWVW-t	MT20	8.0	12.0	4.75	4.25
S BMV+p	MT20	3.0	6.0		
T BVMWVW-t	MT20	6.0	10.0	3.00	2.00
U BS-t	MT20	5.0	6.0		
V BVMWV-t	MT20	5.0	6.0	2.50	2.75
W BVMWV-t	MT20	5.0	6.0		
X BMV-t+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. FACTORED FORCE (LBS)
FR-TO		FROM	TO	FR-TO		FROM	TO
R-G	-795 / 0	0.0	0.0	0.27 (1)	7.81		
R-AV	0 / 7883	-18.5	-18.5	0.59 (1)	10.00		
AV-AW	0 / 7883	-18.5	-18.5	0.59 (1)	10.00		
AW-Q	0 / 7883	-18.5	-18.5	0.59 (1)	10.00		
Q-AX	0 / 3716	-18.5	-18.5	0.31 (1)	10.00		
AX-AY	0 / 3716	-18.5	-18.5	0.31 (1)	10.00		
AY-P	0 / 3716	-18.5	-18.5	0.31 (1)	10.00		
P-AZ	0 / 3532	-18.5	-18.5	0.30 (1)	10.00		
AZ-O	0 / 3532	-18.5	-18.5	0.30 (1)	10.00		
N-O	0 / 17	0.0	0.0	0.08 (1)	10.00		
O-J	-379 / 0	0.0	0.0	0.08 (1)	7.81		
N-M	0 / 102	-18.5	-18.5	0.01 (1)	10.00		

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	2-11-8	-30	-30	---	FRONT	VERT	DEAD	---	C1
C	2-11-8	-127	-127	---	FRONT	VERT	SNOW	---	C1
D	9-6-12	-76	-76	---	BACK	VERT	TOTAL	---	C1
G	23-6-12	-76	-76	---	BACK	VERT	TOTAL	---	C1
I	32-10-8	-30	-30	---	FRONT	VERT	DEAD	---	C1
I	32-10-8	-127	-127	---	FRONT	VERT	SNOW	---	C1
S	23-6-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
V	9-6-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
Y	3-6-12	-89	-89	---	BACK	VERT	TOTAL	---	C1
Z	5-6-12	-76	-76	---	BACK	VERT	TOTAL	---	C1
AA	7-6-12	-76	-76	---	BACK	VERT	TOTAL	---	C1
AB	11-6-12	-76	-76	---	BACK	VERT	TOTAL	---	C1
AC	13-6-12	-76	-76	---	BACK	VERT	TOTAL	---	C1
AD	15-6-12	-76	-76	---	BACK	VERT	TOTAL	---	C1
AE	17-6-12	-76	-76	---	BACK	VERT	TOTAL	---	C1
AF	19-6-12	-76	-76	---	BACK	VERT	TOTAL	---	C1
AG	21-6-12	-76	-76	---	BACK	VERT	TOTAL	---	C1
AH	25-6-12	-72	-72	---	BACK	VERT	TOTAL	---	C1
AI	27-6-12	-72	-72	---	BACK	VERT	TOTAL	---	C1
AJ	29-6-12	-72	-72	---	BACK	VERT	TOTAL	---	C1
AK	31-6-12	-72	-72	---	BACK	VERT	TOTAL	---	C1
AL	1-6-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
AM	3-6-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
AN	5-6-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
AO	7-6-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
AP	11-6-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
AQ	13-6-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
AR	15-6-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
AS	17-6-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
AT	19-6-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
AU	21-6-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
AV	25-6-12	-70	-70	---	BACK	VERT	TOTAL	---	C1
AW	27-6-12	-70	-70	---	BACK	VERT	TOTAL	---	C1
AX	29-6-12	-70	-70	---	BACK	VERT	TOTAL	---	C1
AY	31-6-12	-70	-70	---	BACK	VERT	TOTAL	---	C1
AZ	33-6-12	-72	-72	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.


JSI GRIP= 0.85 (V) (INPUT = 0.90)
JSI METAL= 0.62 (U) (INPUT = 1.00)



Structural component only
DWG# T-2115233 *me*

JOB NAME 410914	TRUSS NAME T2	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 MTek Industries, Inc. Fri May 21 13:22:11 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wlmisz?k45-1zx74QE975EupqBAbFnUO349WtarLzdHCIRQ1YzEHcw

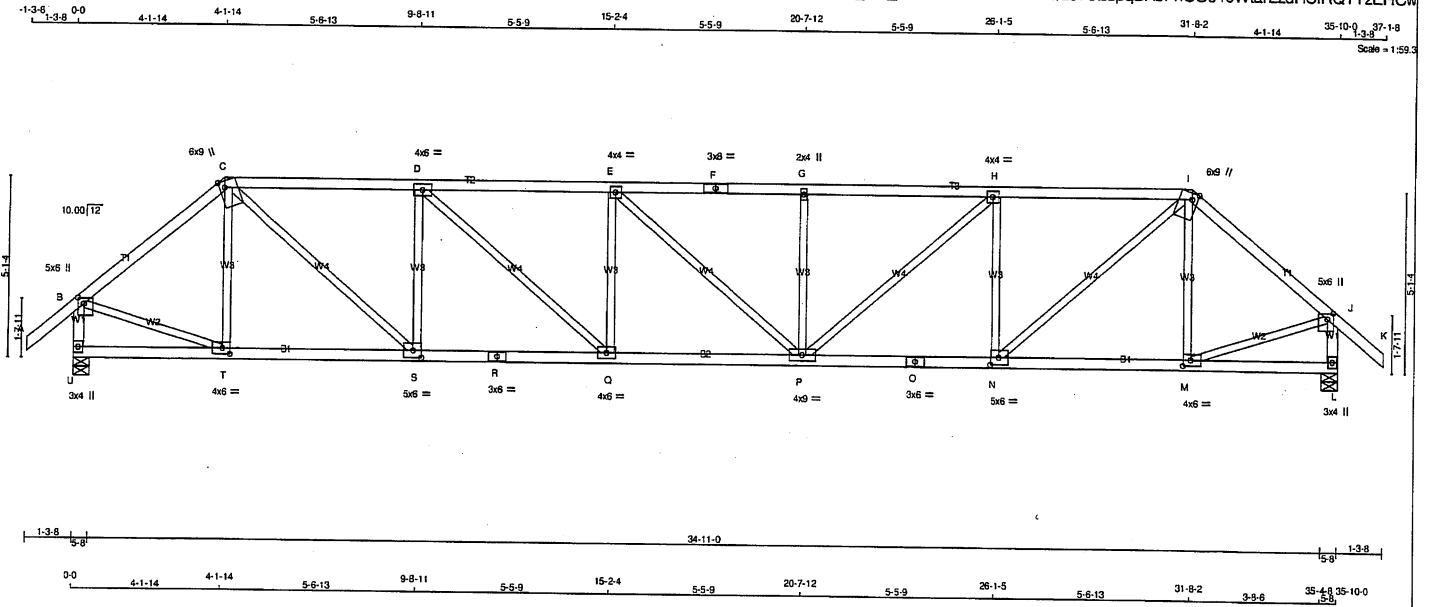

TOTAL WEIGHT = 149 lb

LUMBER			
N L G A. RULES	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - K	2x4	DRY	No.2
U - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
SPF			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW+p	MT20	5.0	6.0 2.00 2.00
C	TTWW+m	MT20	6.0	9.0 Edge 1.75
D	TMVW-t	MT20	4.0	6.0
E	TMVW-t	MT20	4.0	4.0
F	TS-t	MT20	3.0	8.0
G	TMVW-w	MT20	2.0	4.0
H	TMVW-t	MT20	4.0	4.0
I	TTWW+m	MT20	6.0	9.0 Edge 1.75
J	TMVW+p	MT20	5.0	6.0 2.00 2.00
L	BMV1+p	MT20	3.0	4.0
M	BMVW-t	MT20	4.0	6.0 2.00 2.50
N	BMVW-t	MT20	5.0	6.0 2.50 2.75
O	BS-t	MT20	3.0	6.0
P	BMVWVW-t	MT20	4.0	9.0
Q	BMVW-t	MT20	4.0	6.0
R	BS-t	MT20	3.0	6.0
S	BMVW-t	MT20	5.0	6.0 2.50 2.75
T	BMVW-t	MT20	4.0	6.0 2.00 2.50
U	BMV1+p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES: (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	HORZ	GROSS REACTION	DOWN	HORZ	BRG	IN-SX	BRG	IN-SX
U	2102	0	2102	0	0	5-8	5-8	5-8	5-8
L	2102	0	2102	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
U	COMBINED	988 / 0	0 / 0	0 / 0	0 / 0	497 / 0	0 / 0
L	COMBINED	988 / 0	0 / 0	0 / 0	0 / 0	497 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.10 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX LC1 (LC)	UNBRAC LENGTH
FR-TO		FROM	TO	FR-TO			
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00	T-C	-367 / 0	0.14 (1)
B-C	-2002 / 0	-91.8	-91.8 0.36 (1)	4.42	C-S	0 / 1908	0.43 (1)
C-D	-2972 / 0	-91.8	-91.8 0.62 (1)	3.49	S-D	-1146 / 0	0.44 (1)
D-E	-3639 / 0	-91.8	-91.8 0.71 (1)	3.10	D-Q	0 / 889	0.20 (1)
E-F	-3637 / 0	-91.8	-91.8 0.58 (1)	3.28	Q-E	-486 / 0	0.19 (1)
F-G	-3637 / 0	-91.8	-91.8 0.58 (1)	3.28	E-P	-2 / 0	0.00 (1)
G-H	-3637 / 0	-91.8	-91.8 0.71 (1)	3.10	P-G	-486 / 0	0.19 (1)
H-I	-2972 / 0	-91.8	-91.8 0.62 (1)	3.49	P-H	0 / 887	0.20 (1)
I-J	-2002 / 0	-91.8	-91.8 0.36 (1)	4.42	H-N	-1146 / 0	0.44 (1)
J-K	0 / 41	-91.8	-91.8 0.13 (1)	10.00	N-I	0 / 1909	0.43 (1)
U-B	-2074 / 0	0.0	0.0 0.22 (1)	5.87	M-I	-367 / 0	0.14 (1)
L-J	-2074 / 0	0.0	0.0 0.22 (1)	5.87	B-T	0 / 1604	0.36 (1)
					M-J	0 / 1604	0.36 (1)
U-T	0 / 0	-18.5	-18.5 0.10 (4)	10.00			
T-S	0 / 1526	-18.5	-18.5 0.31 (1)	10.00			
S-R	0 / 2972	-18.5	-18.5 0.53 (1)	10.00			
R-Q	0 / 2972	-18.5	-18.5 0.53 (1)	10.00			
Q-P	0 / 3639	-18.5	-18.5 0.64 (1)	10.00			
P-O	0 / 2972	-18.5	-18.5 0.53 (1)	10.00			
O-N	0 / 2972	-18.5	-18.5 0.53 (1)	10.00			
N-M	0 / 1526	-18.5	-18.5 0.31 (1)	10.00			
M-L	0 / 0	-18.5	-18.5 0.10 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.22")
ALLOWABLE DEFL.(TL) = L/360 (1.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.41")

CSI: TC=0.71/1.00 (G-H:1), BC=0.64/1.00 (P-Q:1), WB=0.44/1.00 (D-S:1), SS=0.24/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.86 (H) (INPUT = 0.90)
JSI METAL= 0.93 (O) (INPUT = 1.00)



Structural component only
DWG# T-2115215

JOB NAME 410914	TRUSS NAME T2S	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 13:22:12 2021 Page 1
ID:GzzEEXdtikQL_BH_M?wlmz?k45-V9VVImEouPMIR_mM8zljxGchHh44NmRRMB_a_zEHCV

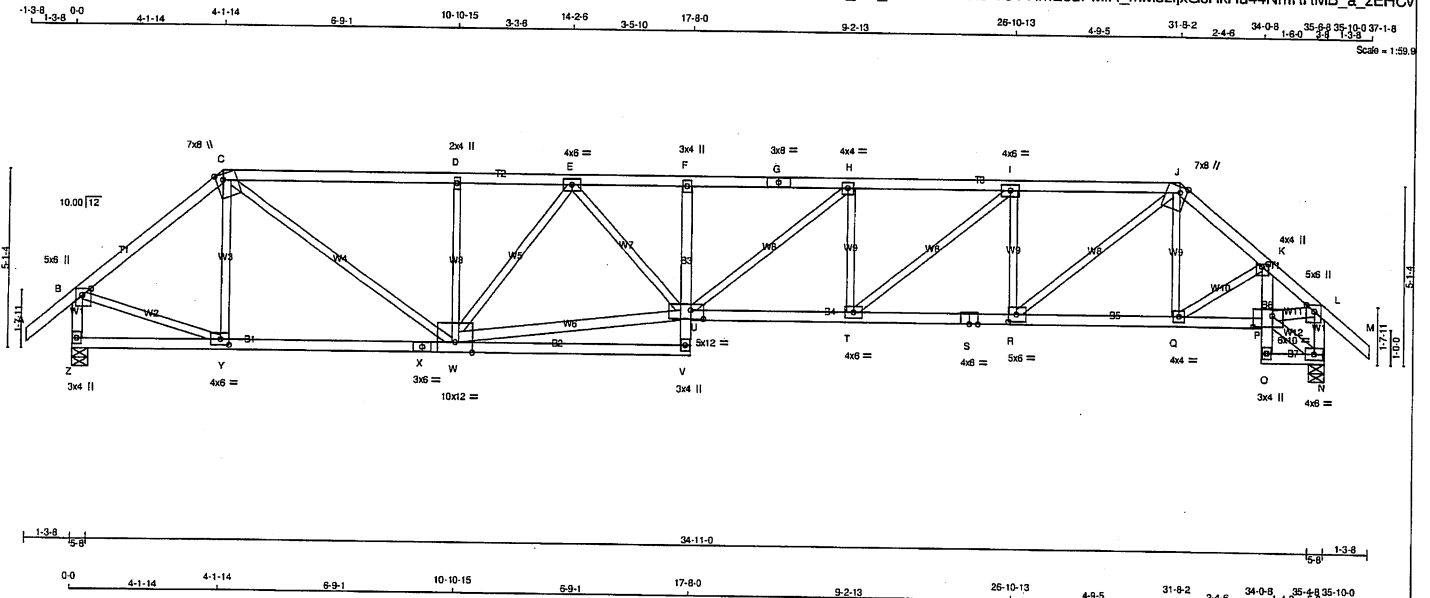

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - G	2x4	DRY	No.2
G - J	2x4	DRY	No.2
J - M	2x4	DRY	No.2
Z - B	2x4	DRY	No.2
N - L	2x4	DRY	No.2
Z - X	2x4	DRY	No.2
X - V	2x4	DRY	No.2
V - S	2x4	DRY	No.2
S - P	2x4	DRY	No.2
O - K	2x4	DRY	No.2
O - N	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
W - U	2x4	DRY	No.2
P - N	2x4	DRY	No.2
P - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	5.0	6.0	Edge 2.75
C	TTWW+m	MT20	7.0	8.0	Edge 2.25
D	TMVW+w	MT20	2.0	4.0	
E	TMVW-t	MT20	4.0	6.0	
F	TMV+p	MT20	3.0	4.0	
G	TS-t	MT20	3.0	8.0	
H	TMVW-t	MT20	4.0	4.0	
I	TMVW-t	MT20	4.0	6.0	
J	TTWW+m	MT20	7.0	8.0	Edge 2.25
K	TMVW+p	MT20	4.0	4.0	1.00 2.00
L	TMVW+p	MT20	5.0	6.0	Edge 2.75
N	BMVW-t	MT20	4.0	6.0	
O	BMV+p	MT20	3.0	4.0	
P	BMVW-t	MT20	6.0	10.0	3.75 6.50
Q	BMVW-t	MT20	4.0	4.0	
R	BMVW-t	MT20	5.0	6.0	2.50 2.75
S	BS-t	MT20	4.0	6.0	
T	BMVW-t	MT20	4.0	6.0	
U	BMVWW-t	MT20	5.0	12.0	3.00 4.50

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
Z	2100	0	2100	0
N	2105	0	2105	0

UNFACTORED REACTIONS

	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
Z	1483	986 / 0	0 / 0	0 / 0	0 / 0	496 / 0	0 / 0
N	1486	989 / 0	0 / 0	0 / 0	0 / 0	497 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Z, N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.91 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 41	-91.8 -91.8 0.13 (1)	10.00	C-W	-357 / 0	0.14 (1)	
B-C	-2002 / 0	-91.8 -91.8 0.36 (1)	4.42	C-W	0 / 2048	0.46 (1)	
C-D	-3195 / 0	-91.8 -91.8 0.94 (1)	3.10	W-D	-623 / 0	0.24 (1)	
D-E	-3197 / 0	-91.8 -91.8 0.67 (1)	3.10	W-U	0 / 3764	0.51 (1)	
E-F	-4618 / 0	-91.8 -91.8 0.47 (1)	2.96	U-H	0 / 336	0.08 (1)	
F-G	-4659 / 0	-91.8 -91.8 0.58 (1)	2.91	T-H	-634 / 0	0.16 (1)	
G-H	-4659 / 0	-91.8 -91.8 0.58 (1)	2.91	Q-J	0 / 63	0.02 (1)	
H-I	-4397 / 0	-91.8 -91.8 0.62 (1)	2.92	Q-K	-74 / 0	0.01 (1)	
I-J	-3510 / 0	-91.8 -91.8 0.50 (1)	3.36	B-Y	0 / 1604	0.36 (1)	
J-K	-2490 / 0	-91.8 -91.8 0.17 (1)	4.23	P-N	-68 / 0	0.01 (1)	
K-L	-2540 / 0	-91.8 -91.8 0.19 (1)	4.17	P-L	0 / 1934	0.31 (1)	
L-M	0 / 41	-91.8 -91.8 0.13 (1)	10.00	W-E	-1203 / 0	0.64 (1)	
Z-B	-2074 / 0	0.0 0.0 0.22 (1)	5.87	E-U	0 / 1126	0.25 (1)	
N-L	-2051 / 0	0.0 0.0 0.22 (1)	5.91	R-J	0 / 2050	0.46 (1)	
				T-I	0 / 1146	0.26 (1)	
Z-Y	0 / 0	-18.5 -18.5 0.12 (4)	10.00	R-I	-1194 / 0	0.30 (1)	
Y-X	0 / 1526	-18.5 -18.5 0.34 (1)	10.00				
X-W	0 / 1526	-18.5 -18.5 0.34 (1)	10.00				
W-V	0 / 156	-18.5 -18.5 0.21 (4)	10.00				
V-U	0 / 55	0.0 0.0 0.22 (1)	10.00				
U-F	-407 / 0	0.0 0.0 0.23 (1)	7.81				
U-T	0 / 4397	-18.5 -18.5 0.77 (1)	10.00				
T-S	0 / 3510	-18.5 -18.5 0.61 (1)	10.00				
S-R	0 / 3510	-18.5 -18.5 0.61 (1)	10.00				
R-Q	0 / 1905	-18.5 -18.5 0.36 (1)	10.00				
Q-P	0 / 1969	-18.5 -18.5 0.37 (1)	10.00				
P-K	0 / 17	0.0 0.0 0.09 (1)	10.00				
K-N	-96 / 0	0.0 0.0 0.09 (1)	7.81				
O-N	0 / 56	-18.5 -18.5 0.02 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.29")
ALLOWABLE DEFL.(TL) = L/360 (1.19")
CALCULATED VERT. DEFL.(TL) = L/777 (0.55")

CSI: TC=0.94/1.00 (C-D:1), BC=0.77/1.00 (T-U:1),
WB=0.64/1.00 (E-W:1), SSI=0.28/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MT20	650	371
	1747	788
	1987	1873

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (S) (INPUT = 0.90)
JSI METAL = 0.78 (U) (INPUT = 1.00)



Structural component only
DWG# T-2115216

CONTINUED ON PAGE 2

JOB NAME 410914	TRUSS NAME T2S	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri May 21 13:22:12 2021 Page 2
ID:GzzEEXDtkQt BH M?wmsz?k45-V9VVImEouPMIR mM8zlixGchkhlu44NmRRMB a zEHCv

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
V	BMV+p	MT20	3.0	4.0		
W	BMW+WW+I	MT20	10.0	12.0	Edge	
X	BS-t	MT20	3.0	6.0		
Y	BMW+I	MT20	4.0	6.0	2.00	2.75
Z	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

NOTES- (1)


1) Lateral braces to be a minimum of 2x4 SPF #2



Structural component only
DWG# T-2115216 *in*

JOB NAME 410915	TRUSS NAME T2S1	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 14:32:55 2021 Page 1
ID:GzzEEXDtfkQt_BH_M?wmsz?k45-mRNxpbbHf3xz1eqCZwJP1rSuH1lKwZ6_V??YzEGAc

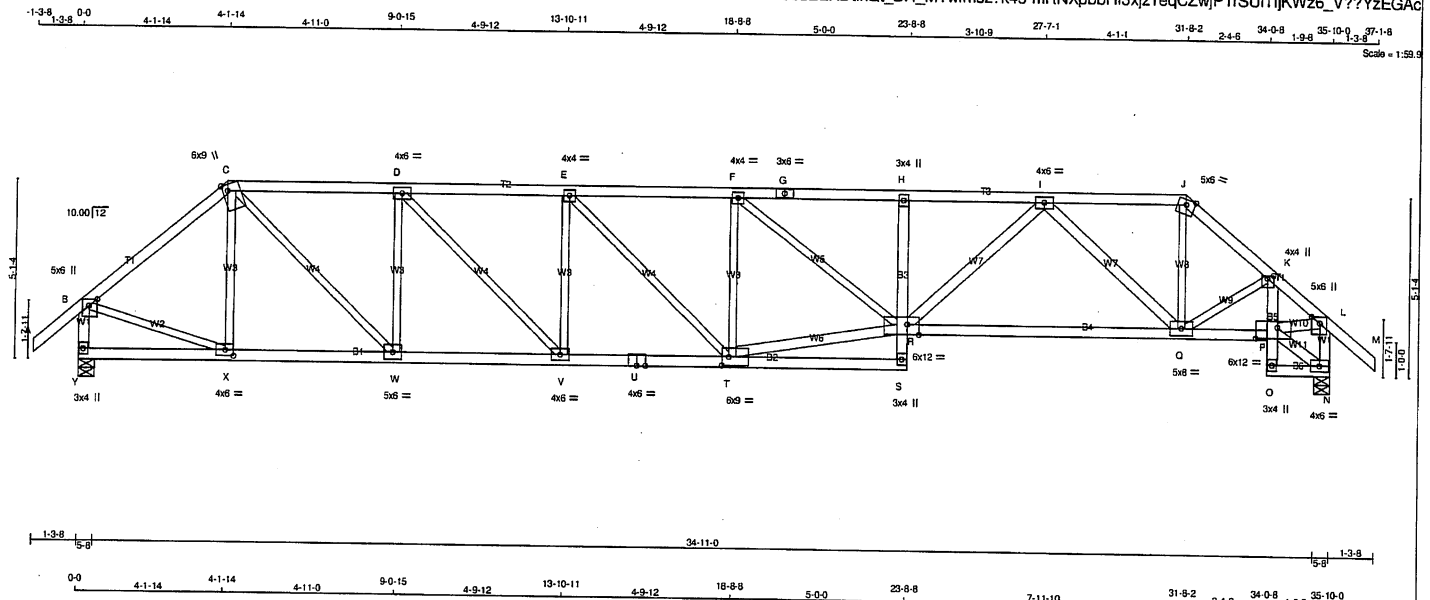

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - G	2x4	DRY	No.2
G - J	2x4	DRY	No.2
J - M	2x4	DRY	No.2
Y - B	2x4	DRY	No.2
N - L	2x4	DRY	No.2
Y - U	2x4	DRY	No.2
U - S	2x4	DRY	No.2
S - H	2x4	DRY	No.2
R - P	2x4	DRY	No.2
O - K	2x4	DRY	No.2
O - N	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
P - N	2x4	DRY	No.2
P - L	2x4	DRY	No.2
R - I	2x4	DRY	No.2
I - Q	2x4	DRY	No.2
T - R	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	5.0	6.0	Edge	2.75
C TTWW+m	MT20	6.0	9.0	Edge	1.75
D TMVW-t	MT20	4.0	6.0		
E TMVW-t	MT20	4.0	4.0		
F TMVW-t	MT20	4.0	4.0		
G TS-t	MT20	3.0	6.0		
H TMV+p	MT20	3.0	4.0		
I TMVW-t	MT20	4.0	6.0		
J TTW-m	MT20	5.0	6.0	Edge	
K TMVW+p	MT20	4.0	4.0	1.00	2.00
L TMVW+p	MT20	5.0	6.0	Edge	2.75
N BMVW-t	MT20	4.0	6.0		
O BMV+p	MT20	3.0	4.0		
P BMVW-t	MT20	6.0	12.0	3.75	7.50
Q BMVW-t	MT20	5.0	8.0		
R BMVW-t	MT20	6.0	12.0	Edge	4.00
S BMV+p	MT20	3.0	4.0		
T BMVW-t	MT20	6.0	9.0	3.00	2.25

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
Y	2100	HORZ	DOWN	IN-SX	IN-SX
N	2105	0	2105	0	5-8
UNFACTORED REACTIONS		1ST LCASE	MAX./MIN. COMPONENT REACTIONS		
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
Y	1483	986 / 0	0 / 0	0 / 0	496 / 0
N	1486	989 / 0	0 / 0	0 / 0	497 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Y, N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.05 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO	VERT. LOAD (PLF)	FR-TO	VERT. LOAD (PLF)
A-B	0 / 41	X-C	-372 / 0
B-C	-1997 / 0	Q-J	0 / 1334
C-D	-2826 / 0	Q-K	-45 / 10
D-E	-3517 / 0	B-X	0 / 1600
E-F	-3703 / 0	P-N	-68 / 0
F-G	-4163 / 0	P-L	0 / 1928
G-H	-4163 / 0	R-I	0 / 1259
H-I	-4194 / 0	I-Q	-1830 / 0
I-J	-1958 / 0	C-W	0 / 1821
J-K	-2509 / 0	T-F	-818 / 0
K-L	-2536 / 0	W-D	-1183 / 0
L-M	0 / 41	E-T	0 / 265
Y-B	-2070 / 0	D-V	0 / 977
N-L	-2051 / 0	T-R	-608 / 0
Y-X	0 / 0	F-R	0 / 3672
X-W	0 / 1522		0 / 570
W-V	0 / 2826		
V-U	0 / 3517		
U-T	0 / 3517		
T-S	0 / 117		
S-R	0 / 41		
R-H	-388 / 0		
R-Q	0 / 3280		
Q-P	0 / 1961		
O-P	0 / 17		
P-K	-121 / 0		
O-N	0 / 56		

TOTAL WEIGHT = 164 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6	PSF
DL	= 6.0	PSF
BOT CH. LL	= 0.0	PSF
DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.24")
ALLOWABLE DEFL.(TL)= L/360 (1.19")
CALCULATED VERT. DEFL.(TL) = L/946 (0.45")

CSI: TC=0.58/1.00 (F-H:1), BC=0.67/1.00 (Q-R:1),
WB=0.68/1.00 (I-Q:1), SS=0.21/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	650	371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (U) (INPUT = 0.90)
JSI METAL = 0.78 (U) (INPUT = 1.00)



Structural component only
DWG# T-2115234

CONTINUED ON PAGE 2

JOB NAME 410915	TRUSS NAME T2S1	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES TRUSS DESC.	DRWG NO.
---------------------------	---------------------------	----------------------	-----------------	---	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 14:32:55 2021 Page 2
ID:GzEEEXDtikQt BH M?wImSz?k45-mRNxobbHf3xiz1eqCZwJP1rSUf1IikWz6 V??YzEGAc

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
U	BS-t	MT20	4.0	6.0		
V	BMWW-t	MT20	4.0	6.0		
W	BMWW-t	MT20	5.0	6.0		
X	BMWW-t	MT20	4.0	6.0	2.00	2.75
Y	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

NOTES- (1)


- 1) Lateral braces to be a minimum of 2x4 SPF #2



Structural component only
DWG# T-2115234 *MR*

JOB NAME 410914	TRUSS NAME T3	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri May 21 13:22:13 2021 Page 1	

ID:GzzEEXDtkQt_BH_M?wlmssz?k45-L3tV6FQfUc37LYgpyTU9TigHLor7ag?wx6QzEHCu

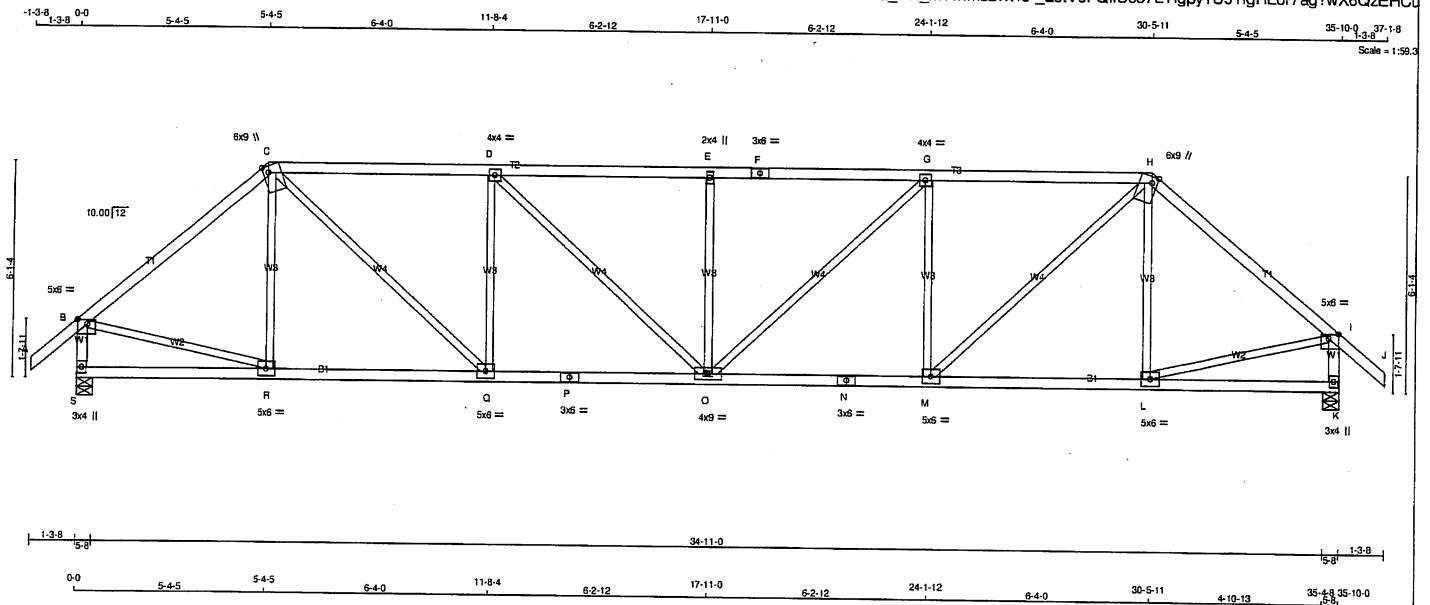

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
S - B	2x4	DRY	No.2
K - I	2x4	DRY	No.2
S - P	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.50	3.25
C	TTWW+m	MT20	6.0	9.0	Edge	1.75
D	TMW-w	MT20	4.0	4.0		
E	TMW+w	MT20	2.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMW-w	MT20	4.0	4.0		
H	TTWW+m	MT20	6.0	9.0	Edge	1.75
I	TMVW-p	MT20	5.0	6.0	1.50	3.25
K	BMV1+p	MT20	3.0	4.0		
L, M, Q, R						
L	BMW-w	MT20	5.0	6.0		
N	BS-t	MT20	3.0	6.0		
O	BMW-w	MT20	4.0	9.0		
P	BS-t	MT20	3.0	6.0		
S	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	UP	IN-SX
S	2102	0	0	5-8
K	2102	0	0	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1484	988 / 0	0 / 0	0 / 0	0 / 0	497 / 0	0 / 0
K	1484	988 / 0	0 / 0	0 / 0	0 / 0	497 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.15 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 41	-91.8 -91.8	0.13 (1)	10.00	R-C	-253 / 6	0.15 (1)
B-C	-2049 / 0	-91.8 -91.8	0.65 (1)	4.07	C-Q	0 / 1603	0.36 (1)
C-D	-2749 / 0	-91.8 -91.8	0.80 (1)	3.38	Q-D	-969 / 0	0.57 (1)
D-E	-3092 / 0	-91.8 -91.8	0.86 (1)	3.15	D-O	0 / 470	0.11 (1)
E-F	-3092 / 0	-91.8 -91.8	0.86 (1)	3.15	O-E	-527 / 0	0.31 (1)
F-G	-3092 / 0	-91.8 -91.8	0.86 (1)	3.15	O-G	0 / 470	0.11 (1)
G-H	-2749 / 0	-91.8 -91.8	0.80 (1)	3.38	M-G	-969 / 0	0.57 (1)
H-I	-2049 / 0	-91.8 -91.8	0.65 (1)	4.07	M-H	0 / 1603	0.36 (1)
I-J	0 / 41	-91.8 -91.8	0.13 (1)	10.00	L-H	-253 / 6	0.15 (1)
S-B	-2063 / 0	0.0 0.0	0.22 (1)	5.89	B-R	0 / 1615	0.36 (1)
K-I	-2063 / 0	0.0 0.0	0.22 (1)	5.89	L-I	0 / 1615	0.36 (1)
S-R	0 / 0	-18.5 -18.5	0.15 (4)	10.00			
R-Q	0 / 1566	-18.5 -18.5	0.34 (1)	10.00			
Q-P	0 / 2749	-18.5 -18.5	0.51 (1)	10.00			
P-O	0 / 2749	-18.5 -18.5	0.51 (1)	10.00			
O-N	0 / 2749	-18.5 -18.5	0.51 (1)	10.00			
N-M	0 / 2749	-18.5 -18.5	0.51 (1)	10.00			
M-L	0 / 1566	-18.5 -18.5	0.34 (1)	10.00			
L-K	0 / 0	-18.5 -18.5	0.15 (4)	10.00			

TOTAL WEIGHT = 150 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OSC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.17")
ALLOWABLE DEFL.(TL) = $L/360$ (1.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.31")
CSI: TC=0.86/1.00 (D-E:1), BC=0.51/1.00 (O-Q:1), WB=0.57/1.00 (G-M:1), SS=0.27/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.86 (I) (INPUT = 0.90)
JSI METAL=0.86 (P) (INPUT = 1.00)




Structural component only
DWG# T-2115217

JOB NAME 410914	TRUSS NAME T3S	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri May 21 13:22:14 2021 Page 1
ID:GzzEEXdtfkQt_BH_M?wlmisz?k45-SYdFjSG2Q0cTgHwGOKB0hhP4bXF1jufg4eszEHC

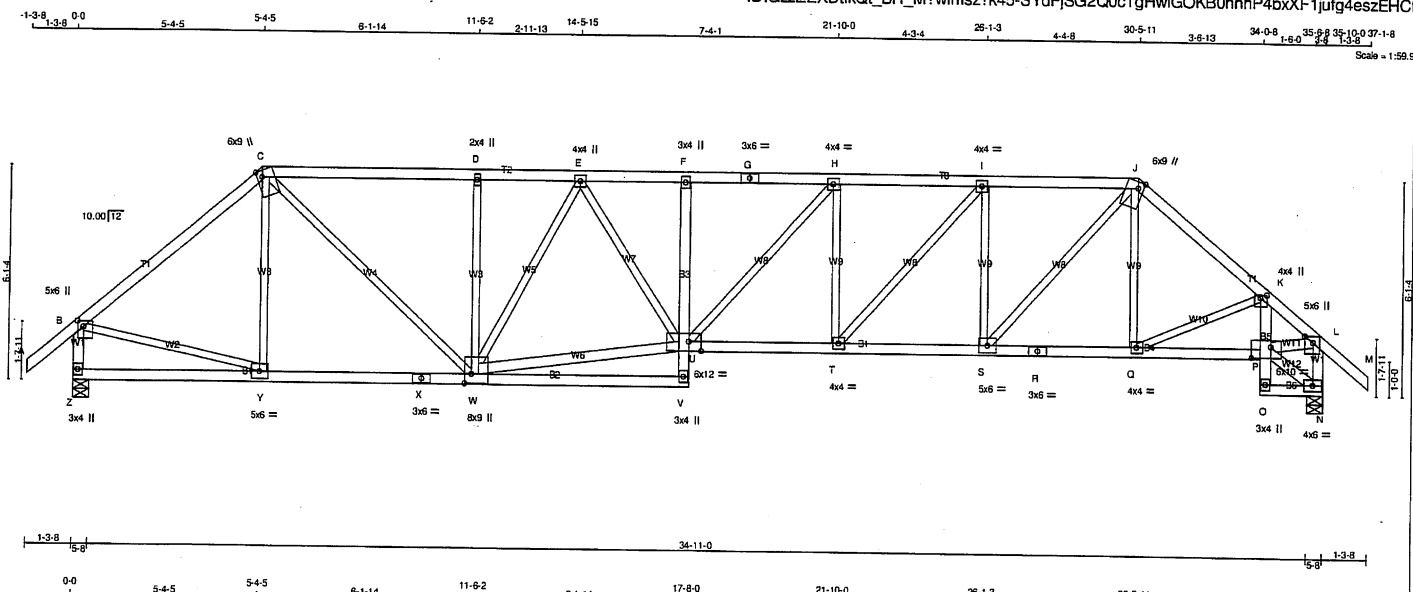

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - G	2x4	DRY	No.2
G - J	2x4	DRY	No.2
J - M	2x4	DRY	No.2
Z - B	2x4	DRY	No.2
N - L	2x4	DRY	No.2
Z - X	2x4	DRY	No.2
X - V	2x4	DRY	No.2
V - F	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - P	2x4	DRY	No.2
O - K	2x4	DRY	No.2
O - N	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
W - U	2x4	DRY	No.2
P - N	2x4	DRY	No.2
P - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW+p	MT20	5.0	6.0 2.00 2.00
C	TTWW+m	MT20	6.0	9.0 Edge 1.75
D	TMVW-w	MT20	2.0	4.0
E	TMVW+t	MT20	4.0	4.0
F	TMV+p	MT20	3.0	6.0
G	TS-t	MT20	3.0	6.0
H	TMVW-t	MT20	4.0	4.0
I	TMVW-t	MT20	4.0	4.0
J	TTWW+m	MT20	6.0	9.0 Edge 1.75
K	TMVW+p	MT20	4.0	4.0 1.00 2.00
L	TMVW+p	MT20	5.0	6.0 Edge 2.75
N	BMVW-t	MT20	4.0	6.0
O	BMV+p	MT20	3.0	4.0
P	BMVW-t	MT20	6.0	10.0 3.75 6.50
Q	BMVW-t	MT20	4.0	4.0
R	BS-t	MT20	3.0	6.0
S	BMVW-t	MT20	5.0	6.0
T	BMVW-t	MT20	4.0	4.0
U	BMVW-t	MT20	6.0	12.0 3.25 4.25

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
Z	2100	0	2100	0	5-8
N	2105	0	2105	0	5-8

UNFACTORED REACTIONS		1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
Z	1483	986 / 0	0 / 0	0 / 0	0 / 0	496 / 0	0 / 0	
N	1486	989 / 0	0 / 0	0 / 0	0 / 0	497 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Z, N

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.40 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0 / 41	Y-C	-257 / 0
B-C	-2045 / 0	C-W	0 / 1578
C-D	-2710 / 0	W-D	-567 / 0
D-E	-2712 / 0	W-U	0 / 3125
E-F	-3687 / 0	Q-J	0 / 87
F-G	-3687 / 0	Q-K	-156 / 0
G-H	-3687 / 0	B-Y	0 / 1612
H-I	-3518 / 0	P-N	-69 / 0
I-J	-2933 / 0	P-L	0 / 1979
J-K	-2452 / 0	W-E	-1020 / 0
K-L	-2572 / 0	E-U	0 / 917
L-M	0 / 41	S-J	0 / 1576
Z-B	-2060 / 0	U-H	0 / 253
N-L	-2050 / 0	S-I	-1089 / 0
		T-H	-576 / 0
		T-I	0 / 882
Z-Y	0 / 0		
Y-X	0 / 1563		
X-W	0 / 1563		
W-V	0 / 96		
V-U	0 / 50		
U-F	-370 / 0		
U-T	0 / 3518		
T-S	0 / 2933		
S-R	0 / 1871		
R-Q	0 / 1871		
Q-P	0 / 2013		
O-P	0 / 17		
P-K	-116 / 0		
O-N	0 / 56		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.13")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CSI: TC=0.67/1.00 (C-D:1), BC=0.61/1.00 (T-U:1), WB=0.72/1.00 (E-W:1), SS=0.26/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (E) (INPUT = 0.90)
JSI METAL= 0.63 (W) (INPUT = 1.00)



Structural component only
DWG# T-2115218 112

JOB NAME 410914	TRUSS NAME T3S	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	---	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 13:22:14 2021 Page 2
ID:GzzEEXDtIkQt BH M?wimsz?k45-SYdFISG2Q0cTqHwIGOKB0hhhP4bxXF1ufg4eszEHC

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
V	BMV+p	MT20	3.0	4.0		
W	BMW+WW+H	MT20	8.0	9.0	3.25	2.25
X	BS-t	MT20	3.0	6.0		
Y	BMW+W-t	MT20	5.0	6.0		
Z	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.


NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2



Structural component only
DWG# T-2115218 *ur*

JOB NAME 410915	TRUSS NAME T3S1	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 14:32:56 2021 Page 1
ID:GzzEEXDtKQt_BH_M?wmsz?k45-Fexv0xbvQN3abBD0mHRyxEOa23PYSk46LeYX?zEGAB

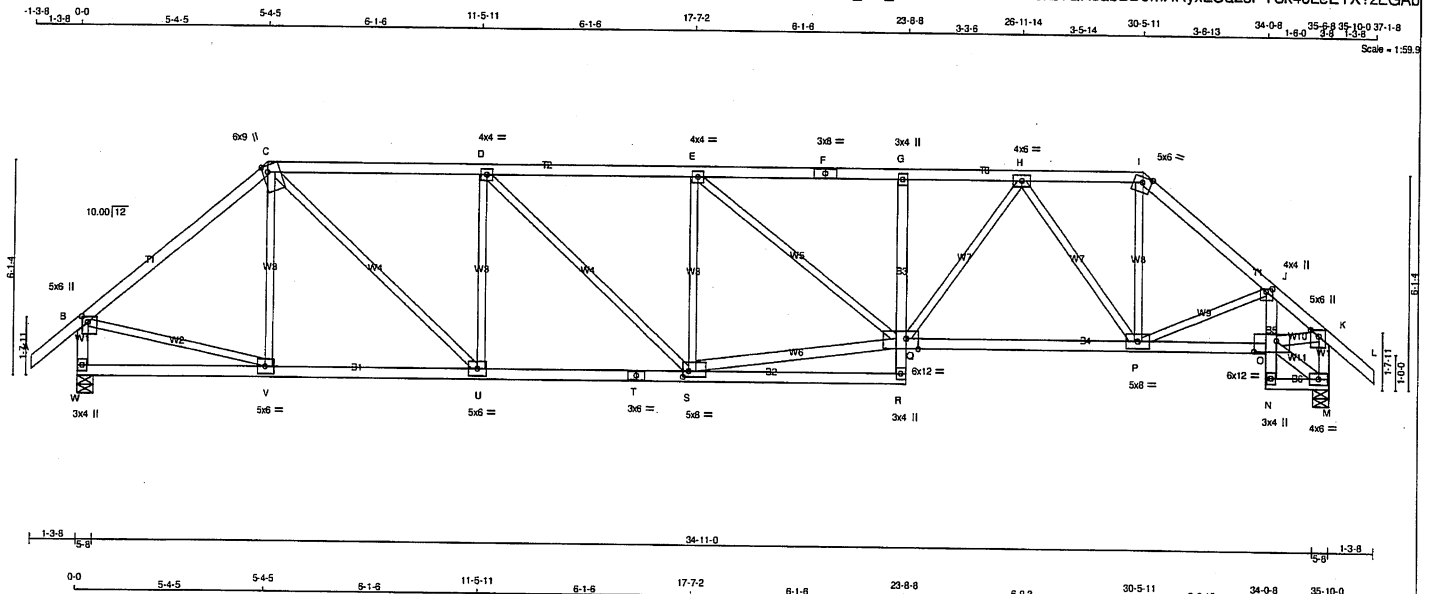

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. SPF TOTAL WEIGHT = 164 lb

CHORDS	SIZE	LUMBER	DESCR.	SPF
A - C	2x4	DRY	No.2	SPF
C - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
I - L	2x4	DRY	No.2	SPF
W - B	2x4	DRY	No.2	SPF
M - K	2x4	DRY	No.2	SPF
W - T	2x4	DRY	No.2	SPF
T - R	2x4	DRY	No.2	SPF
R - G	2x4	DRY	No.2	SPF
Q - O	2x4	DRY	No.2	SPF
N - J	2x4	DRY	No.2	SPF
N - M	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
S - Q	2x4	DRY	No.2	SPF
O - M	2x4	DRY	No.2	SPF
O - K	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	5.0	6.0	2.00	2.00
C TTWW+m	MT20	6.0	9.0	Edge	1.75
D TMVW-t	MT20	4.0	4.0		
E TMVW-t	MT20	4.0	4.0		
F TS-t	MT20	3.0	8.0		
G TMV+p	MT20	3.0	4.0		
H TMVW-t	MT20	4.0	6.0		
I TTW-m	MT20	5.0	6.0	Edge	
J TMVW+p	MT20	4.0	4.0	1.00	2.00
K TMVW+p	MT20	5.0	6.0	Edge	2.75
M BMVW-t	MT20	4.0	6.0		
N BMV+p	MT20	3.0	4.0		
O BVWVW-t	MT20	6.0	12.0	3.75	7.50
P BVWVW-t	MT20	5.0	8.0		
Q BVWVW-t	MT20	6.0	12.0	Edge	4.00
R BMV+p	MT20	3.0	4.0		
S BVWVW-t	MT20	5.0	8.0	2.00	2.00
T BS-t	MT20	3.0	6.0		
U BVWVW-t	MT20	5.0	6.0		
V BVWVW-t	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UP
W	2100	0	2100	0
M	2105	0	2105	0

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
W	1483	986 / 0	0 / 0	0 / 0	0 / 0	496 / 0	0 / 0
M	1486	989 / 0	0 / 0	0 / 0	0 / 0	497 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) W, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.24 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO		FR-TO		FROM TO	
A-B	0 / 41	-91.8 -91.8	0.13 (1)	10.00	V-C	-253 / 6	0.15 (1)
B-C	-2046 / 0	-91.8 -91.8	0.64 (1)	4.07	C-U	0 / 1583	0.36 (1)
C-D	-2718 / 0	-91.8 -91.8	0.73 (1)	3.49	U-D	-980 / 0	0.57 (1)
D-E	-3088 / 0	-91.8 -91.8	0.79 (1)	3.24	D-S	0 / 515	0.12 (1)
E-F	-3319 / 0	-91.8 -91.8	0.88 (1)	3.31	S-E	-732 / 0	0.43 (1)
F-G	-3319 / 0	-91.8 -91.8	0.88 (1)	3.31	S-Q	0 / 3049	0.49 (1)
G-H	-3337 / 0	-91.8 -91.8	0.88 (1)	3.31	E-Q	0 / 284	0.06 (1)
H-I	-1905 / 0	-91.8 -91.8	0.20 (1)	4.69	P-I	0 / 1270	0.29 (1)
I-J	-2461 / 0	-91.8 -91.8	0.28 (1)	4.16	B-V	-142 / 0	0.04 (1)
J-K	-2569 / 0	-91.8 -91.8	0.19 (1)	4.14	B-V	0 / 1612	0.36 (1)
K-L	0 / 41	-91.8 -91.8	0.13 (1)	10.00	O-M	-69 / 0	0.01 (1)
W-B	-2061 / 0	0.0 0.0	0.22 (1)	5.89	O-K	0 / 1975	0.32 (1)
M-K	-2051 / 0	0.0 0.0	0.22 (1)	5.91	Q-H	0 / 1065	0.24 (1)
W-V	0 / 0	-18.5 -18.5	0.15 (4)	10.00	H-P	-1418 / 0	0.85 (1)
V-U	0 / 1564	-18.5 -18.5	0.34 (1)	10.00			
U-T	0 / 2718	-18.5 -18.5	0.52 (1)	10.00			
T-S	0 / 2718	-18.5 -18.5	0.52 (1)	10.00			
S-R	0 / 89	-18.5 -18.5	0.17 (4)	10.00			
R-Q	0 / 50	0.0 0.0	0.13 (1)	10.00			
Q-P	-450 / 0	0.0 0.0	0.18 (1)	7.81			
P-O	0 / 2720	-18.5 -18.5	0.54 (1)	10.00			
O-N	0 / 2008	-18.5 -18.5	0.42 (1)	10.00			
N-O	0 / 17	0.0 0.0	0.09 (1)	10.00			
O-J	-127 / 0	0.0 0.0	0.09 (1)	7.81			
N-M	0 / 56	-18.5 -18.5	0.02 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.18")
ALLOWABLE DEFL.(TL) = L/360 (1.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.36")

CSI: TC=0.79/1.00 (D-E:1), BC=0.54/1.00 (P-Q:1),
WB=0.85/1.00 (H-P:1), SS=0.26/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (H) (INPUT = 0.90)
JSI METAL= 0.78 (T) (INPUT = 1.00)



Structural component only
DWG# T-2115235

CONTINUE ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410915	T3S1	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 14:32:56 2021 Page 2
ID:GzzEEEXDtIkQt BH M?wImSz?k45-Fexv0xbvQN3abBD0mHRyxEOa23PYSk46LeEYX?zEGAb

PLATES (table is in inches)
JT TYPE PLATES W LEN Y X
W BMV1+p MT20 3.0 4.0

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.


NOTES: (1)
1) Lateral braces to be a minimum of 2x4 SPF #2



Structural component only
DWG# T-2115235 *mn*

JOB NAME 410914	TRUSS NAME T4	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 MTek Industries, Inc. Fri May 21 13:22:15 2021 Page 1
ID:GzEEEDtkQt_BH_M?wmsz?k45-wkBdwoHgBKKIRVxq5sQZvEtzU_yGiWt7JP6BJzEHCs

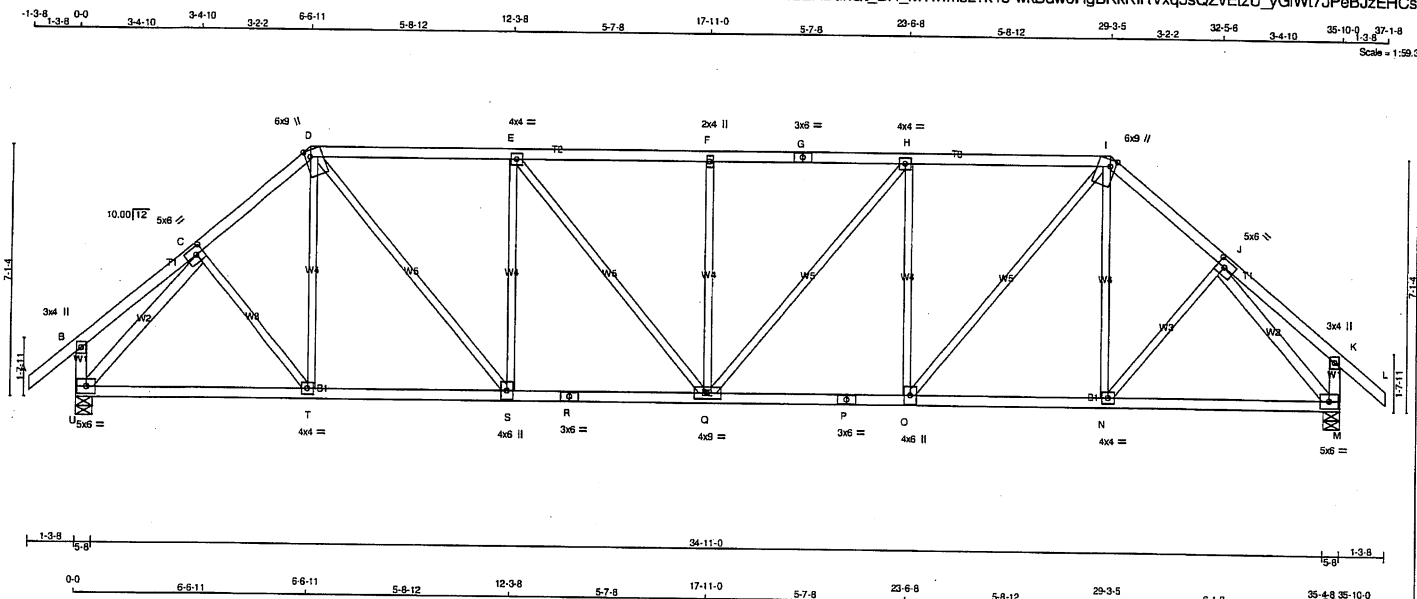

TOTAL WEIGHT = 167 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
I - L	2x4	DRY	No.2	SPF
U - B	2x4	DRY	No.2	SPF
M - K	2x4	DRY	No.2	SPF
U - R	2x4	DRY	No.2	SPF
R - P	2x4	DRY	No.2	SPF
P - M	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
U - C	2x4	DRY	No.2	SPF
J - M	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	5.0	6.0	2.50	2.50
D	TTWW+m	MT20	6.0	9.0	Edge	1.75
E	TMWW-t	MT20	4.0	4.0		
F	TMWW-w	MT20	2.0	4.0		
G	TS-t	MT20	3.0	6.0		
H	TMWW-t	MT20	4.0	4.0		
I	TTWW+m	MT20	6.0	9.0	Edge	1.75
J	TMWW-t	MT20	5.0	6.0	2.50	2.50
K	TMV+p	MT20	3.0	4.0		
M	BMVW-t	MT20	5.0	6.0		
N	BMVW-t	MT20	4.0	4.0		
O	BMVW-t	MT20	4.0	6.0		
P	BS-t	MT20	3.0	6.0		
Q	BMVW-t	MT20	4.0	9.0		
R	BS-t	MT20	3.0	6.0		
S	BMVW-t	MT20	4.0	6.0		
T	BMVW-t	MT20	4.0	4.0		
U	BMVW-t	MT20	5.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES

1)

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
U	2102	0	2102	0
M	2102	0	2102	0

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
U	1484	988 / 0	0 / 0	0 / 0	0 / 0	497 / 0	0 / 0
M	1484	988 / 0	0 / 0	0 / 0	0 / 0	497 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.65 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 41	-91.8 -91.8	0.13 (1)	10.00	C-T	0 / 165	0.04 (1)
B-C	0 / 20	-91.8 -91.8	0.14 (1)	10.00	T-D	0 / 75	0.03 (4)
C-D	-2071 / 0	-91.8 -91.8	0.20 (1)	4.53	D-S	0 / 1273	0.29 (1)
D-E	-2391 / 0	-91.8 -91.8	0.59 (1)	3.83	S-E	-876 / 0	0.77 (1)
E-F	-2631 / 0	-91.8 -91.8	0.62 (1)	3.65	E-Q	0 / 376	0.08 (1)
F-G	-2631 / 0	-91.8 -91.8	0.62 (1)	3.65	Q-F	-475 / 0	0.42 (1)
G-H	-2631 / 0	-91.8 -91.8	0.62 (1)	3.65	Q-H	0 / 376	0.08 (1)
H-I	-2391 / 0	-91.8 -91.8	0.59 (1)	3.83	O-H	-876 / 0	0.77 (1)
I-J	-2071 / 0	-91.8 -91.8	0.20 (1)	4.53	O-I	0 / 1273	0.29 (1)
J-K	0 / 20	-91.8 -91.8	0.14 (1)	10.00	N-I	0 / 75	0.03 (4)
K-L	0 / 41	-91.8 -91.8	0.13 (1)	10.00	N-J	0 / 165	0.04 (1)
U-B	-244 / 0	0.0 0.0	0.03 (1)	7.81	U-C	-2326 / 0	0.71 (1)
M-K	-244 / 0	0.0 0.0	0.03 (1)	7.81	J-M	-2326 / 0	0.71 (1)
U-T	0 / 1463	-18.5 -18.5	0.34 (1)	10.00			
T-S	0 / 1570	-18.5 -18.5	0.36 (1)	10.00			
S-R	0 / 2391	-18.5 -18.5	0.44 (1)	10.00			
R-Q	0 / 2391	-18.5 -18.5	0.44 (1)	10.00			
Q-P	0 / 2391	-18.5 -18.5	0.44 (1)	10.00			
P-O	0 / 2391	-18.5 -18.5	0.44 (1)	10.00			
O-N	0 / 1570	-18.5 -18.5	0.36 (1)	10.00			
N-M	0 / 1463	-18.5 -18.5	0.34 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.13")
ALLOWABLE DEFL.(TL) = $L/360$ (1.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.24")

CSI: TC=0.62/1.00 (F-H:1), BC=0.44/1.00 (O-Q:1),
WB=0.77/1.00 (H-O:1), SSI=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX	MIN	MAX
MT20	650	371
	1747	788
	1987	1873

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.87 (C) (INPUT = 0.90)
JSI METAL= 0.74 (R) (INPUT = 1.00)



Structural component only
DWG# T-2115219

JOB NAME 410914	TRUSS NAME T4S	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 13:22:16 2021 Page 1
ID:GzzEEEXDtkQt_BH_M?wmsz?k45-Owk087HlxsBwb47NoNf56n0tUil?830Mz9BjzEHCr

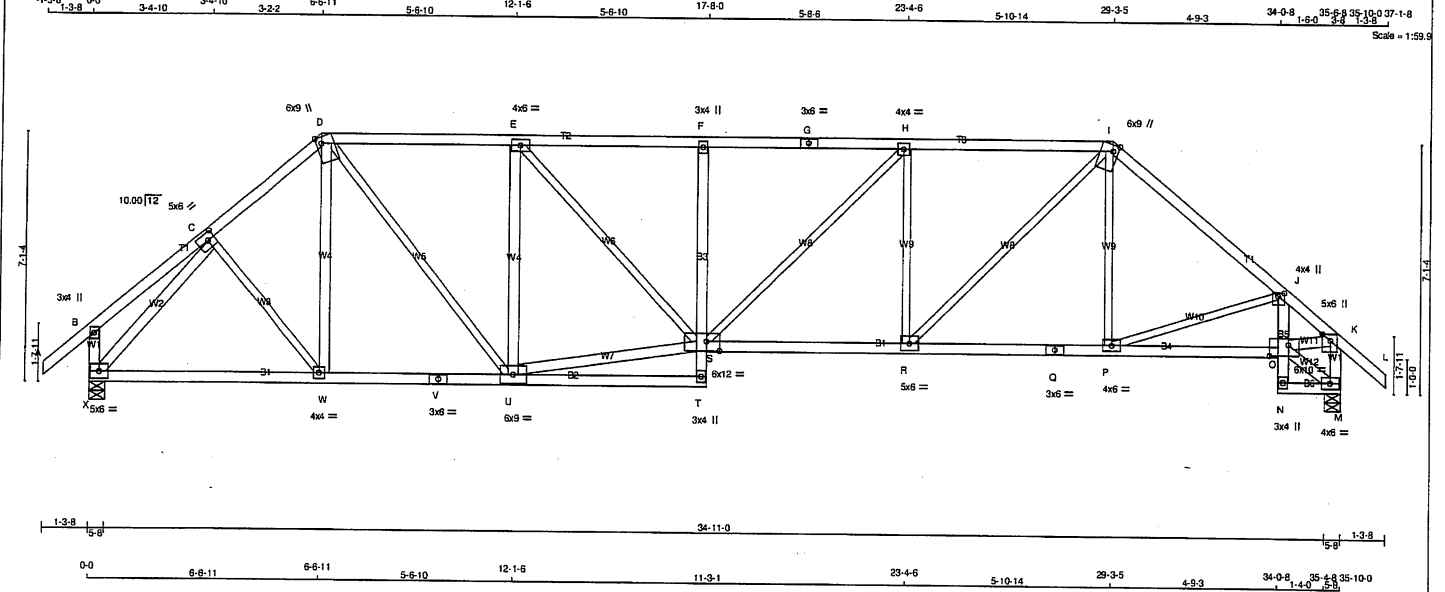

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER DESCR. TOTAL WEIGHT = 176 lb

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - G	2x4	DRY No.2	SPF
G - I	2x4	DRY No.2	SPF
I - L	2x4	DRY No.2	SPF
X - B	2x4	DRY No.2	SPF
M - K	2x4	DRY No.2	SPF
X - V	2x4	DRY No.2	SPF
V - T	2x4	DRY No.2	SPF
T - F	2x4	DRY No.2	SPF
S - Q	2x4	DRY No.2	SPF
Q - O	2x4	DRY No.2	SPF
N - J	2x4	DRY No.2	SPF
N - M	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF
W - D	2x4	DRY No.2	SPF
U - E	2x4	DRY No.2	SPF
U - S	2x4	DRY No.2	SPF
X - C	2x4	DRY No.2	SPF
O - M	2x4	DRY No.2	SPF
O - K	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-t	MT20	5.0	6.0	2.50	2.50
D	TTWW+m	MT20	6.0	9.0	Edge 1.75	
E	TMVW-t	MT20	4.0	6.0		
F	TMV+p	MT20	3.0	4.0		
G	TS-t	MT20	3.0	6.0		
H	TMVW-t	MT20	4.0	4.0		
I	TTWW+m	MT20	6.0	9.0	Edge 1.75	
J	TMVW+p	MT20	4.0	4.0	1.00	2.00
K	TMVW+p	MT20	5.0	6.0	Edge 2.75	
M	BMVW-t	MT20	4.0	6.0		
N	BMV+p	MT20	3.0	4.0		
O	BMVW-t	MT20	6.0	10.0	3.75	6.50
P	BMVW-t	MT20	4.0	6.0		
Q	BS-t	MT20	3.0	6.0		
R	BMVW-t	MT20	5.0	6.0		

CHORDS
MEMB. MAX. FACTORED FORCE (LBS) VERT. LOAD LC1 MAX. MAX. UNBRAC LENGTH FR-TO

MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 MAX. MAX. UNBRAC LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRAC LENGTH FR-TO
A-B	0 / 41	-91.8 -91.8 0.13 (1)	10.00	C-W	0 / 164 0.04 (1)
B-C	0 / 20	-91.8 -91.8 0.14 (1)	10.00	W-D	0 / 71 0.02 (4)
C-D	-2067 / 0	-91.8 -91.8 0.20 (1)	4.54	D-U	0 / 1259 0.28 (1)
D-E	-2359 / 0	-91.8 -91.8 0.55 (1)	3.91	U-E	-1299 / 0 0.81 (1)
E-F	-3056 / 0	-91.8 -91.8 0.62 (1)	3.42	U-S	0 / 2347 0.38 (1)
F-G	-3067 / 0	-91.8 -91.8 0.74 (1)	3.30	E-S	0 / 1005 0.23 (1)
G-H	-3067 / 0	-91.8 -91.8 0.74 (1)	3.30	P-I	0 / 136 0.04 (4)
H-I	-2818 / 0	-91.8 -91.8 0.70 (1)	3.45	P-J	-267 / 0 0.13 (1)
I-J	-2399 / 0	-91.8 -91.8 0.44 (1)	4.07	X-C	-2322 / 0 0.71 (1)
J-K	-2616 / 0	-91.8 -91.8 0.30 (1)	3.97	O-M	-70 / 0 0.01 (1)
K-L	0 / 41	-91.8 -91.8 0.13 (1)	10.00	O-K	0 / 2043 0.33 (1)
X-B	-244 / 0	0.0 0.0 0.03 (1)	7.81	R-I	0 / 1391 0.31 (1)
M-K	-2050 / 0	0.0 0.0 0.22 (1)	5.91	S-H	0 / 351 0.08 (1)
X-W	0 / 1460	-18.5 -18.5 0.33 (1)	10.00	R-H	-857 / 0 0.50 (1)
W-V	0 / 1568	-18.5 -18.5 0.35 (1)	10.00		
V-U	0 / 1568	-18.5 -18.5 0.35 (1)	10.00		
U-T	0 / 63	-18.5 -18.5 0.12 (4)	10.00		
T-S	0 / 47	0.0 0.0 0.09 (1)	10.00		
S-F	-474 / 0	0.0 0.0 0.24 (1)	7.81		
S-R	0 / 2818	-18.5 -18.5 0.53 (1)	10.00		
R-Q	0 / 1825	-18.5 -18.5 0.36 (1)	10.00		
Q-P	0 / 1825	-18.5 -18.5 0.36 (1)	10.00		
P-O	0 / 2077	-18.5 -18.5 0.40 (1)	10.00		
N-O	0 / 17	0.0 0.0 0.09 (1)	10.00		
O-J	-130 / 0	0.0 0.0 0.09 (1)	7.81		
N-M	0 / 57	-18.5 -18.5 0.02 (4)	10.00		

WEBS
MEMB. MAX. FACTORED FORCE (LBS) MAX. UNBRAC LENGTH FR-TO

MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRAC LENGTH FR-TO
A-B	0 / 41	-91.8 -91.8 0.13 (1)
B-C	0 / 20	-91.8 -91.8 0.14 (1)
C-D	-2067 / 0	-91.8 -91.8 0.20 (1)
D-E	-2359 / 0	-91.8 -91.8 0.55 (1)
E-F	-3056 / 0	-91.8 -91.8 0.62 (1)
F-G	-3067 / 0	-91.8 -91.8 0.74 (1)
G-H	-3067 / 0	-91.8 -91.8 0.74 (1)
H-I	-2818 / 0	-91.8 -91.8 0.70 (1)
I-J	-2399 / 0	-91.8 -91.8 0.44 (1)
J-K	-2616 / 0	-91.8 -91.8 0.30 (1)
K-L	0 / 41	-91.8 -91.8 0.13 (1)
X-B	-244 / 0	0.0 0.0 0.03 (1)
M-K	-2050 / 0	0.0 0.0 0.22 (1)
X-W	0 / 1460	-18.5 -18.5 0.33 (1)
W-V	0 / 1568	-18.5 -18.5 0.35 (1)
V-U	0 / 1568	-18.5 -18.5 0.35 (1)
U-T	0 / 63	-18.5 -18.5 0.12 (4)
T-S	0 / 47	0.0 0.0 0.09 (1)
S-F	-474 / 0	0.0 0.0 0.24 (1)
S-R	0 / 2818	-18.5 -18.5 0.53 (1)
R-Q	0 / 1825	-18.5 -18.5 0.36 (1)
Q-P	0 / 1825	-18.5 -18.5 0.36 (1)
P-O	0 / 2077	-18.5 -18.5 0.40 (1)
N-O	0 / 17	0.0 0.0 0.09 (1)
O-J	-130 / 0	0.0 0.0 0.09 (1)
N-M	0 / 57	-18.5 -18.5 0.02 (4)

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN./C
LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015
THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014
DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.
(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD
ALLOWABLE DEFL.(LL) = L/360 (1.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.16")
ALLOWABLE DEFL.(TL) = L/360 (1.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.31")
CSI: TC=0.74/1.00 (F-H:1), BC=0.53/1.00 (R-S:1), WB=0.81/1.00 (E-U:1), SS=0.26/1.00 (H-I:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10
COMPANION LIVE LOAD FACTOR = 1.00
AUTOSOLVE HEELS OFF
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.
NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873
PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.89 (U) (INPUT = 0.90)
JSI METAL= 0.53 (G) (INPUT = 1.00)



Structural component only
DWG# T-2115220

JOB NAME 410914	TRUSS NAME T4S	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 13:22:16 2021 Page 2
ID:GzzEEEXDtKQt_BH_M?wlmisz?k45-Owk087HixdsBwb47NoNf56n0tull?830Mz9BilzEHC

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
S	BMVWW-I	MT20	6.0	12.0	3.25	4.50
T	BMV+p	MT20	3.0	4.0		
U	BMVWW-t	MT20	6.0	9.0		
V	BS-t	MT20	3.0	6.0		
W	BMVWW-t	MT20	4.0	4.0		
X	BMVW1-t	MT20	5.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2




Structural component only
DWG# T-2115220 *7/1*

JOB NAME 410915	TRUSS NAME T4S1	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 14:32:57 2021 Page 1	

ID:GzzEEXDtkQt_BH_M?wlmssz?k45-jqVHEHcBGRDnDK_yBUSwoJsm0BDGGal_64RzEGAA

Scale = 1/32" = 1'-0"

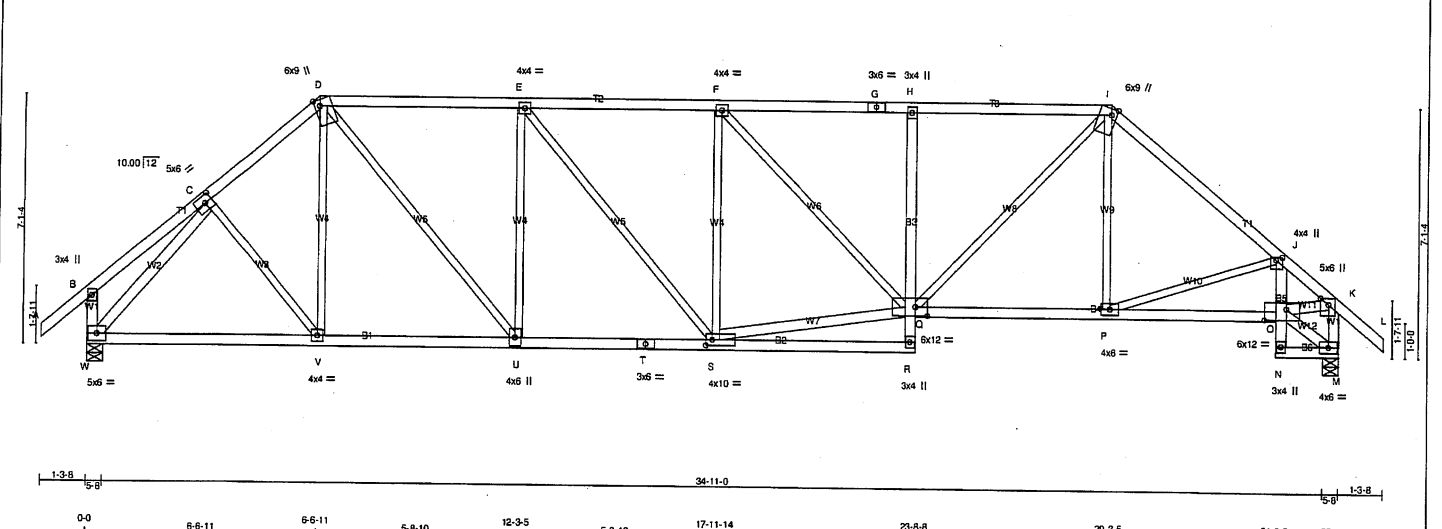

LUMBER N.L.G.A. RULES CHORDS SIZE LUMBER DESCR. TOTAL WEIGHT = 173 lb

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - G	2x4	DRY No.2	SPF
G - I	2x4	DRY No.2	SPF
I - L	2x4	DRY No.2	SPF
W - B	2x4	DRY No.2	SPF
M - K	2x4	DRY No.2	SPF
W - T	2x4	DRY No.2	SPF
T - R	2x4	DRY No.2	SPF
R - H	2x4	DRY No.2	SPF
Q - O	2x4	DRY No.2	SPF
N - J	2x4	DRY No.2	SPF
N - M	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF
S - Q	2x4	DRY No.2	SPF
W - C	2x4	DRY No.2	SPF
O - M	2x4	DRY No.2	SPF
O - K	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
JT	VERT	HORZ	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
W	2100	0	2100	0	5-8
M	2105	0	2105	0	5-8

UNFACTORED REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
W	1483	986 / 0	0 / 0	0 / 0	496 / 0
M	1486	989 / 0	0 / 0	0 / 0	497 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) W, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

C-P	0 / 20	-91.8	-91.8	0.14 (1)	10.00	V-D	0 / 77	0.03 (4)
D-E	-2068 / 0	-91.8	-91.8	0.20 (1)	4.53	D-U	0 / 1270	0.29 (1)
E-F	-2390 / 0	-91.8	-91.8	0.60 (1)	3.82	U-E	-876 / 0	0.77 (1)
F-G	-2625 / 0	-91.8	-91.8	0.63 (1)	3.64	E-S	0 / 371	0.08 (1)
G-H	-2772 / 0	-91.8	-91.8	0.61 (1)	3.58	S-F	-625 / 0	0.55 (1)
H-I	-2772 / 0	-91.8	-91.8	0.61 (1)	3.58	S-Q	0 / 2612	0.42 (1)
I-J	-2782 / 0	-91.8	-91.8	0.62 (1)	3.58	F-Q	0 / 203	0.05 (1)
J-K	-2402 / 0	-91.8	-91.8	0.44 (1)	4.06	Q-I	0 / 1360	0.31 (1)
K-L	-2616 / 0	-91.8	-91.8	0.30 (1)	3.97	P-I	0 / 147	0.05 (4)
W-B	-244 / 0	-91.8	-91.8	0.13 (1)	10.00	P-J	-265 / 0	0.12 (1)
M-K	-2050 / 0	0.0	0.0	0.03 (1)	7.81	W-C	-2323 / 0	0.71 (1)
		0.0	0.0	0.22 (1)	5.91	O-M	-70 / 0	0.01 (1)
						O-K	0 / 2043	0.33 (1)
W-V	0 / 1461	-18.5	-18.5	0.34 (1)	10.00			
V-U	0 / 1568	-18.5	-18.5	0.36 (1)	10.00			
U-T	0 / 2390	-18.5	-18.5	0.46 (1)	10.00			
T-S	0 / 2390	-18.5	-18.5	0.46 (1)	10.00			
S-R	0 / 60	-18.5	-18.5	0.15 (4)	10.00			
R-Q	0 / 46	0.0	0.0	0.09 (1)	10.00			
Q-H	-576 / 0	0.0	0.0	0.31 (1)	7.81			
Q-P	0 / 1827	-18.5	-18.5	0.38 (1)	10.00			
P-O	0 / 2076	-18.5	-18.5	0.42 (1)	10.00			
N-O	0 / 17	0.0	0.0	0.09 (1)	10.00			
O-J	-132 / 0	0.0	0.0	0.09 (1)	7.81			
N-M	0 / 57	-18.5	-18.5	0.02 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL)= L/360 (1.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.27")

CSI: TC=0.83/1.00 (E-F:1), BC=0.46/1.00 (S-U:1), WB=0.77/1.00 (E-U:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (S) (INPUT = 0.90)
JSI METAL = 0.72 (T) (INPUT = 1.00)



Structural component only
DWG# T-2115236

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.																					
410915	T4S1	1	1	TRUSS DESC.																							
Tamarack Roof Truss, Burlington				Version 8.420 S Jan 21 2021 MITek Industries, Inc. Fri May 21 14:32:57 2021 Page 2 ID:GzzEEXDtkQt BH M?wlmsz?k45-igVHEHcXBgBRDLnDK yBUSwoJSm0BDgGal 64RzEGAA																							
PLATES (table is in inches) <table border="1"><thead><tr><th>JT</th><th>TYPE</th><th>PLATES</th><th>W</th><th>LEN</th><th>Y</th><th>X</th></tr></thead><tbody><tr><td>V</td><td>BMWW-t</td><td>MT20</td><td>4.0</td><td>4.0</td><td></td><td></td></tr><tr><td>W</td><td>BMWW-t</td><td>MT20</td><td>5.0</td><td>6.0</td><td></td><td></td></tr></tbody></table> Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD. NOTES: (1) 1) Lateral braces to be a minimum of 2x4 SPF #2							JT	TYPE	PLATES	W	LEN	Y	X	V	BMWW-t	MT20	4.0	4.0			W	BMWW-t	MT20	5.0	6.0		
JT	TYPE	PLATES	W	LEN	Y	X																					
V	BMWW-t	MT20	4.0	4.0																							
W	BMWW-t	MT20	5.0	6.0																							
 Structural component only DWG# T-2115236 <i>HN</i>																											

CONTINUED ON PAGE 2

JOB NAME 410915	TRUSS NAME T5S1	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 14:32:58 2021 Page 2
ID:GzzEEXDtfkQt BH M?wlmsz?k45-B03fRdd9y JlgVMPtTQ0fTxVs6Xwh?PoyjftzEGAZ

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
R	BMV+p	MT20	3.0	4.0		
S	BMWW-t	MT20	6.0	9.0		
T	BS-t	MT20	3.0	6.0		
U	BMWW-t	MT20	4.0	6.0		
V	BMWW-t	MT20	4.0	4.0		
W	BMWW-t	MT20	5.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

NOTES- (1)


1) Lateral braces to be a minimum of 2x4 SPF #2



Structural component only
DWG# T-2115237 *in*

JOB NAME 410914	TRUSS NAME T6	QUANTITY 2	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 MITek Industries, Inc. Fri May 21 13:22:18 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wlmzsz?k45-KJsmYpJYTF6u9dVWDP7AXsOsh0JT9RpHelnezEHCP

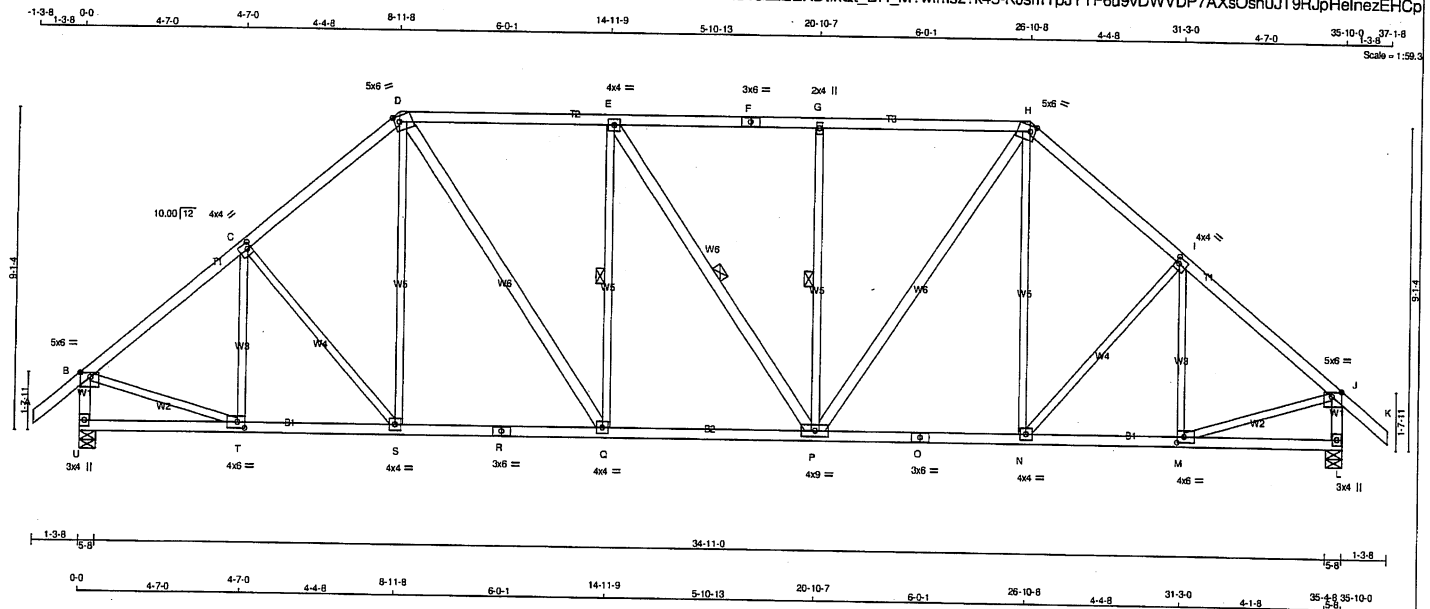

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
U - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
D - Q	2x4	DRY	No.2
E - P	2x4	DRY	No.2
P - H	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.50	3.25
C	TMVW-t	MT20	4.0	4.0	2.00	1.25
D	TTWW-m	MT20	5.0	6.0	2.00	1.75
E	TMVW-t	MT20	4.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMVW-w	MT20	2.0	4.0		
H	TTWW-m	MT20	5.0	6.0	2.00	1.75
I	TMVW-t	MT20	4.0	4.0	2.00	1.25
J	TMVW-p	MT20	5.0	6.0	1.50	3.25
L	BMV1+p	MT20	3.0	4.0		
M	BMVW-t	MT20	4.0	6.0	2.00	2.50
N, Q, S						
N	BMVW-t	MT20	4.0	4.0		
O	BS-t	MT20	3.0	6.0		
P	BMVW-w	MT20	4.0	4.0		
R	BS-t	MT20	3.0	6.0		
T	BMVW-t	MT20	4.0	6.0	2.00	2.50
U	BMV1+p	MT20	3.0	4.0		

NOTES

1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	VERT	HORIZ	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
			DOWN	UP	DOWN	UP		
U	2102	0	2102	0	0	0	5-8	5-8
L	2102	0	2102	0	0	0	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	1ST LCASE		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
		SNOW	LIVE	PERM. LIVE	WIND			
U	1484	988 / 0	0 / 0	0 / 0	0 / 0	497 / 0	0 / 0	0 / 0
L	1484	988 / 0	0 / 0	0 / 0	0 / 0	497 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.14 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-Q, E-P, G-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	FR-TO	CHORDS		WEBS	
		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00
B-C	-2036 / 0	-91.8	-91.8	0.41 (1)	4.35
C-D	-2006 / 0	-91.8	-91.8	0.40 (1)	4.38
D-E	-1995 / 0	-91.8	-91.8	0.58 (1)	4.14
E-F	-1994 / 0	-91.8	-91.8	0.57 (1)	4.14
F-G	-1994 / 0	-91.8	-91.8	0.57 (1)	4.14
G-H	-1994 / 0	-91.8	-91.8	0.57 (1)	4.16
H-I	-2006 / 0	-91.8	-91.8	0.40 (1)	4.38
I-J	-2036 / 0	-91.8	-91.8	0.41 (1)	4.35
J-K	0 / 41	-91.8	-91.8	0.13 (1)	10.00
U-B	-2065 / 0	0.0	0.0	0.22 (1)	5.89
L-J	-2065 / 0	0.0	0.0	0.22 (1)	5.89
U-T	0 / 0	-18.5	-18.5	0.08 (4)	10.00
T-S	0 / 1587	-18.5	-18.5	0.31 (1)	10.00
S-R	0 / 1515	-18.5	-18.5	0.32 (1)	10.00
R-Q	0 / 1515	-18.5	-18.5	0.32 (1)	10.00
Q-P	0 / 1996	-18.5	-18.5	0.39 (1)	10.00
P-O	0 / 1515	-18.5	-18.5	0.31 (1)	10.00
O-N	0 / 1515	-18.5	-18.5	0.31 (1)	10.00
N-M	0 / 1587	-18.5	-18.5	0.32 (1)	10.00
M-L	0 / 0	-18.5	-18.5	0.08 (4)	10.00
T-C	-368 / 0	0.16 (1)			
C-S	-113 / 0	0.10 (1)			
S-D	0 / 184	0.05 (4)			
D-Q	0 / 852	0.14 (1)			
Q-E	-591 / 0	0.32 (1)			
E-P	-3 / 0	0.00 (1)			
P-G	-591 / 0	0.32 (1)			
G-H	0 / 849	0.14 (1)			
H-I	0 / 186	0.05 (4)			
I-N	-113 / 0	0.10 (1)			
N-I	-369 / 0	0.16 (1)			
B-T	0 / 1650	0.37 (1)			
M-J	0 / 1650	0.37 (1)			

TOTAL WEIGHT = 2 X 183 = 367 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2015, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL) = L/360 (1.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.17")

CSI: TC=0.58/1.00 (D-E:1), BC=0.39/1.00 (P-Q:1), WB=0.37/1.00 (B-T:1), SS=0.26/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.86 (J) (INPUT = 0.90)
JSI METAL= 0.52 (O) (INPUT = 1.00)



Structural component only
DWG# T-2115222

JOB NAME 410914	TRUSS NAME T7	QUANTITY 2	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 MITek Industries, Inc. Fri May 21 13:22:19 2021 Page 1
ID:GzzEEXDtikQt_BH_M?wmsz?k45-oVQ8m9KBEYEl2oi3xwMjIPWk5MyCyxT2xNrK4zEHCC

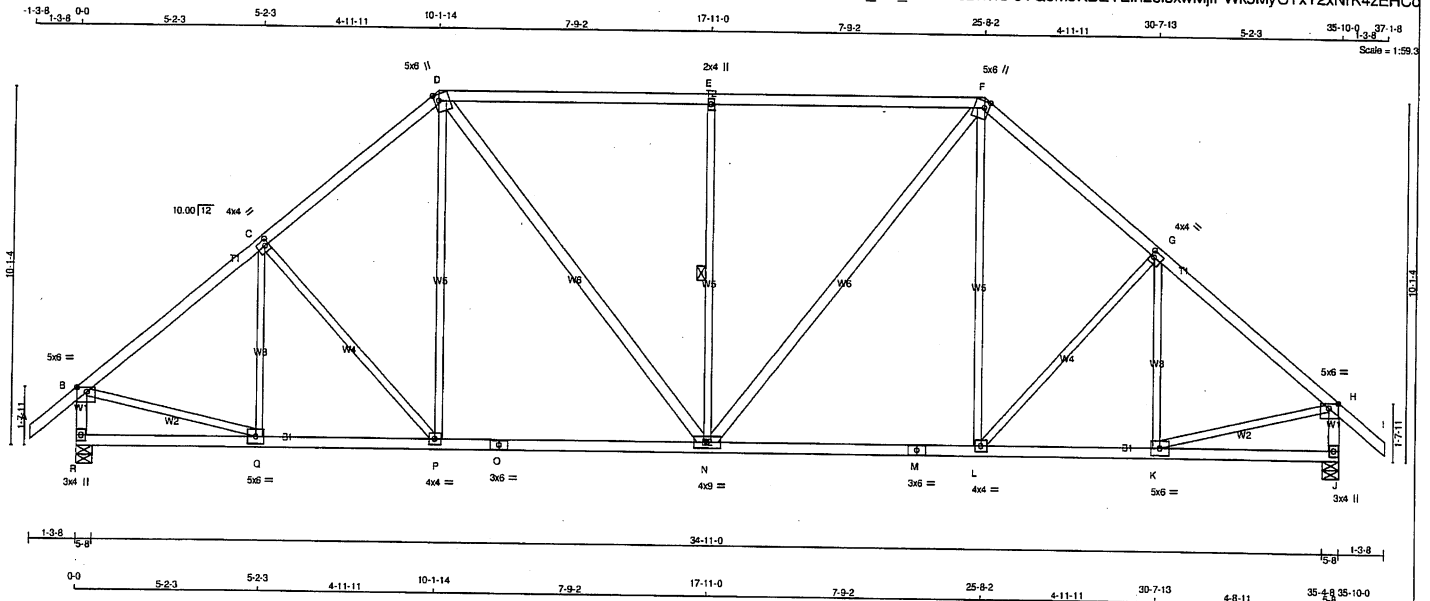

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.50	3.25
C	TMWW-t	MT20	4.0	4.0	2.00	1.25
D	TTWW+m	MT20	5.0	6.0	2.25	1.50
E	TMW-w	MT20	2.0	4.0		
F	TTWW+m	MT20	5.0	6.0	2.25	1.50
G	TMWW-t	MT20	4.0	4.0	2.00	1.25
H	TMVW-p	MT20	5.0	6.0	1.50	3.25
J	BMV1+p	MT20	3.0	4.0		
K	BMWW-t	MT20	5.0	6.0		
L	BMWW-t	MT20	4.0	4.0		
M	BS-t	MT20	3.0	6.0		
N	BMWW-t	MT20	4.0	9.0		
O	BS-t	MT20	3.0	6.0		
P	BMWW-t	MT20	4.0	4.0		
Q	BMWW-t	MT20	5.0	6.0		
R	BMV1+p	MT20	3.0	4.0		

NOTES:

- 1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ
JT	2102	0	0	5-8
R	2102	0	0	5-8
J	2102	0	0	5-8

UNFACTORED REACTIONS

	1ST CASE	MAX/MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	1484	988 / 0	0 / 0	0 / 0	0 / 0	497 / 0	0 / 0
R	1484	988 / 0	0 / 0	0 / 0	0 / 0	497 / 0	0 / 0
J	1484	988 / 0	0 / 0	0 / 0	0 / 0	497 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.69 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 41	-91.8	-91.8 0.13 (1)	Q-C	-313 / 0	0.17 (1)	
B-C	-2064 / 0	-91.8	-91.8 0.39 (1)	C-P	-209 / 0	0.24 (1)	
C-D	-1958 / 0	-91.8	-91.8 0.37 (1)	P-D	0 / 276	0.06 (1)	
D-E	-1882 / 0	-91.8	-91.8 0.82 (1)	D-N	0 / 654	0.11 (1)	
E-F	-1882 / 0	-91.8	-91.8 0.82 (1)	N-E	-876 / 0	0.81 (1)	
F-G	-1958 / 0	-91.8	-91.8 0.37 (1)	N-F	0 / 654	0.11 (1)	
G-H	-2064 / 0	-91.8	-91.8 0.39 (1)	L-F	0 / 276	0.06 (1)	
H-I	0 / 41	-91.8	-91.8 0.13 (1)	L-G	-209 / 0	0.24 (1)	
R-B	-2060 / 0	0.0	0.0 0.22 (1)	K-G	-313 / 0	0.17 (1)	
J-H	-2060 / 0	0.0	0.0 0.22 (1)	B-Q	0 / 1663	0.37 (1)	
				K-H	0 / 1663	0.37 (1)	
R-Q	0 / 0	-18.5	-18.5 0.10 (4)				
Q-P	0 / 1613	-18.5	-18.5 0.35 (1)				
P-O	0 / 1476	-18.5	-18.5 0.37 (1)				
O-N	0 / 1476	-18.5	-18.5 0.37 (1)				
N-M	0 / 1476	-18.5	-18.5 0.37 (1)				
M-L	0 / 1476	-18.5	-18.5 0.37 (1)				
L-K	0 / 1613	-18.5	-18.5 0.35 (1)				
K-J	0 / 0	-18.5	-18.5 0.10 (4)				

TOTAL WEIGHT = 2 X 175 = 351 lb [M/F]

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.08")
ALLOWABLE DEFL.(TL) = $L/360$ (1.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.18")

CSI: TC=0.82/1.00 (D-E:1), BC=0.37/1.00 (L-N:1), WB=0.61/1.00 (E-N:1), SS=0.35/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.86 (H) (INPUT = 0.90)
JSI METAL= 0.47 (H) (INPUT = 1.00)



Structural component only
DWG# T-2115223

JOB NAME 410914	TRUSS NAME T8	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

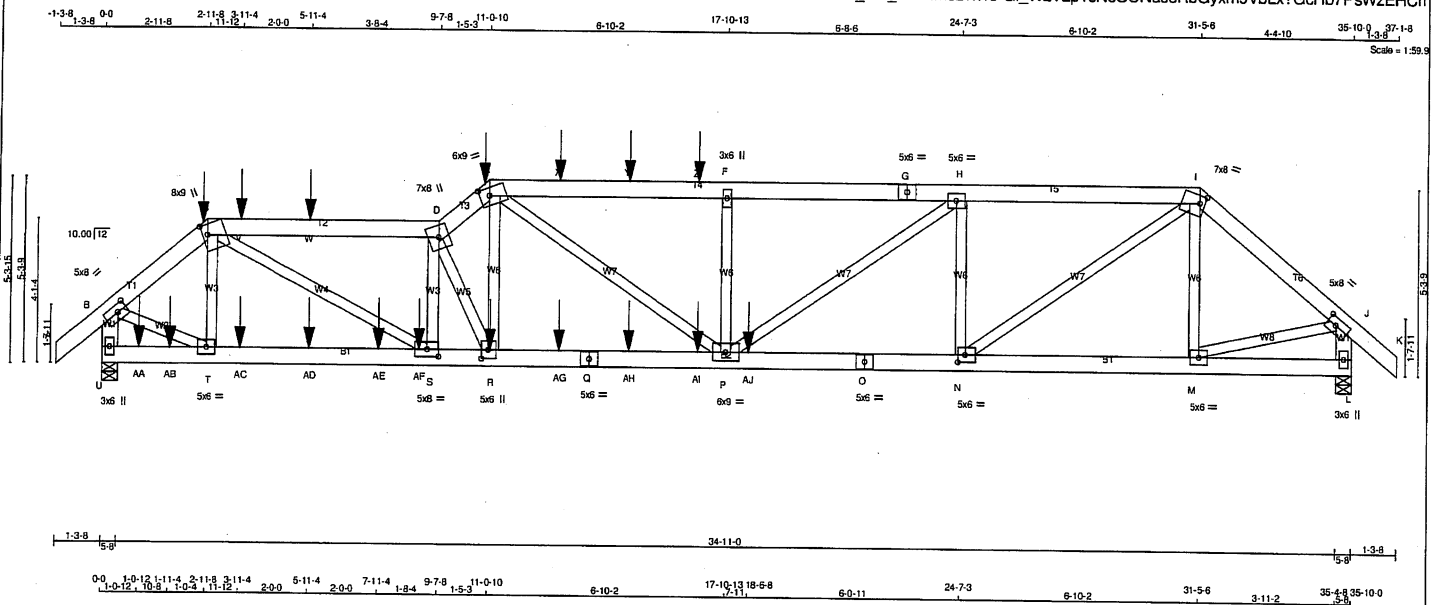

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x6	DRY	No.2
C - D	2x6	DRY	No.2
D - E	2x6	DRY	No.2
E - G	2x6	DRY	No.2
G - I	2x6	DRY	No.2
I - K	2x6	DRY	No.2
U - B	2x6	DRY	No.2
L - J	2x6	DRY	No.2
U - Q	2x6	DRY	No.2
Q - O	2x6	DRY	No.2
O - L	2x6	DRY	No.2
ALL WEBS EXCEPT	2x4	DRY	No.2

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	2	12
C - D	2	12
D - E	2	12
E - G	2	12
G - I	2	12
I - K	2	12
U - B	2	12
L - J	2	12
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
U - Q	2	12
Q - O	2	12
O - L	2	12
WEBS : (0.122"x3") SPIRAL NAILS		
2x4	1	6

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	U	GROSS REACTION	VERT	DOWN	HORIZ	BRG	IN-SX	BRG	IN-SX
4770	0	4770	0	4770	0	5-8	5-8	5-8	5-8
3819	0	3819	0	3819	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	U	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
3367	2246	0	0/0	0/0	0/0	0/0	1121/0	0/0
2695	1805	0	0/0	0/0	0/0	0/0	890/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.54 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	FORCE	MEMB.	FORCE
FR-TO	FR-TO	FR-TO	FR-TO
A-B	0/42	T-C	-945/0
B-C	-4958/0	C-S	0/6851
C-V	-9743/0	S-D	-3117/0
V-W	-9743/0	D-R	-4438/0
W-D	-9743/0	R-E	0/4806
D-E	-10534/0	E-P	-678/0
E-X	-9954/0	P-B	0/4024
X-Y	-9954/0	B-M	0/3274
Y-Z	-9954/0	M-I	0/4963
Z-F	-9954/0	F-P	0/2096
F-G	-9954/0	P-H	-2614/0
G-H	-9954/0	H-P	-671/0
H-I	-7221/0	P-H	0/3371
I-J	-4155/0		
J-K	0/42		
U-B	-4827/0		
L-J	-3789/0		

U-AA	AA-AB	AB-T	T-AC	AC-AD	AD-AE	AE-AF	AF-S	S-R	R-AG	AG-Q	Q-AH	AH-AI	AI-P	P-AJ	AJ-O	O-N	N-M	M-L
0/0	0/0	0/0	0/3749	0/3749	0/3749	0/3749	0/3749	0/9968	0/8238	0/8238	0/8238	0/8238	0/8238	0/7221	0/7221	0/7221	0/3159	0/0
-18.5	-18.5	-18.5	-18.5	-18.5	-18.5	-18.5	-18.5	-18.5	-18.5	-18.5	-18.5	-18.5	-18.5	-18.5	-18.5	-18.5	-18.5	-18.5
0.13	0.13	0.13	0.42	0.42	0.42	0.42	0.42	0.71	0.81	0.81	0.81	0.81	0.81	0.74	0.74	0.74	0.25	0.04
10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	2-11-8	-30	-30	---	FRONT	VERT.	DEAD	---	C1
C	2-11-8	-127	-127	---	FRONT	VERT.	SNOW	---	C1
E	11-0-10	-30	-30	---	FRONT	VERT.	DEAD	---	C1

TOTAL WEIGHT = 2 X 218 = 436 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
BOT CH.	LL	= 6.0	PSF
	DL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD)
EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.23")
ALLOWABLE DEFL.(TL) = L/360 (1.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.41")

CSI: TC=0.46/1.00 (C-D:1), BC=0.81/1.00 (P-R:1),
WB=0.61/1.00 (C-S:1), SS=0.65/1.00 (N-P:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MT20	650	371
	1747	788
	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (S) (INPUT = 0.90)
JSI METAL = 0.83 (Q) (INPUT = 1.00)

CONTINUED ON PAGE 2



Structural component only
DWG# T-2115224 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410914	T8	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 13:22:20 2021 Page 2
ID:GzzEEXDfKQt BH M?wmsz?k45-Gi WzVLp?sNcOCNuceRbGyxm9VbLx?GcHb7PsWzEHcn

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-t	MT20	5.0	8.0	2.50	3.25
C	TTWW+m	MT20	8.0	9.0	3.50	1.75
D	TTWW+m	MT20	7.0	8.0		
E	TTWW-m	MT20	6.0	9.0	2.75	3.25
F	TMWW-w	MT20	3.0	6.0		
G	TS-t	MT20	5.0	6.0		
H	TMWW-t	MT20	5.0	6.0		
I	TTWW-m	MT20	7.0	8.0	2.75	1.75
J	TMWW-t	MT20	5.0	8.0	2.50	3.25
L	BMV1+p	MT20	3.0	6.0		
M	BMWW-t	MT20	5.0	6.0		
N	BMWW-t	MT20	5.0	6.0	2.50	2.50
O	BS-t	MT20	5.0	6.0		
P	BMWWW-t	MT20	6.0	9.0		
Q	BS-t	MT20	5.0	6.0		
R	BMWW-t	MT20	5.0	6.0	3.00	2.25
S	BMWW-t	MT20	5.0	8.0	2.50	3.75
T	BMWW-t	MT20	5.0	6.0		
U	BMV1+p	MT20	3.0	6.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	11-0-10	-56	-56	---	BACK	VERT	TOTAL	---	C1
E	11-0-10	-127	-127	---	FRONT	VERT	SNOW	---	C1
R	11-1-4	-168	-168	---	BACK	VERT	TOTAL	---	C1
V	3-11-4	-77	-77	---	BACK	VERT	TOTAL	---	C1
W	5-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
X	13-1-4	-23	-23	---	BACK	VERT	TOTAL	---	C1
Y	15-1-4	-23	-23	---	BACK	VERT	TOTAL	---	C1
Z	17-1-4	-23	-23	---	BACK	VERT	TOTAL	---	C1
AA	1-0-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
AB	1-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AC	3-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AD	5-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AE	7-11-4	-168	-168	---	BACK	VERT	TOTAL	---	C1
AF	9-1-4	-168	-168	---	BACK	VERT	TOTAL	---	C1
AG	13-1-4	-168	-168	---	BACK	VERT	TOTAL	---	C1
AH	15-1-4	-168	-168	---	BACK	VERT	TOTAL	---	C1
AI	17-1-4	-168	-168	---	BACK	VERT	TOTAL	---	C1
AJ	18-6-8	-1402	-1402	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2115224 2/2

JOB NAME 410916	TRUSS NAME T8Z	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 14:57:45 2021 Page 2
ID:GzzEEEXDtkQt BH M?wlmzs?k45-85PoX4dvlslk0YCUV7nEZ4MHVPgCqHkoQqIBzEFpK

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	8.0	2.50	3.25
C	TTWW+m	MT20	8.0	12.0	Edge	6.50
D	TTWW+m	MT20	6.0	9.0	4.50	2.25
E	TTWW-m	MT20	6.0	10.0	2.75	3.25
F	TMW+w	MT20	3.0	6.0		
G	TS-t	MT20	5.0	6.0		
H	TMWW-t	MT20	5.0	6.0		
I	TTWW+m	MT20	8.0	9.0	3.50	2.50
J	TMVW-t	MT20	5.0	8.0	2.50	3.25
L	BMV1+p	MT20	3.0	6.0		
M	BMWW-t	MT20	5.0	6.0		
N	BMWW-t	MT20	5.0	6.0	2.50	2.25
O	BS-t	MT20	5.0	6.0		
P	BMWWW-t	MT20	6.0	9.0	3.75	2.25
Q	BS-t	MT20	5.0	6.0		
R	BMWW-t	MT20	5.0	6.0	2.75	2.25
S	BMWW-t	MT20	6.0	9.0		
T	BMWW-t	MT20	5.0	6.0	2.50	2.75
U	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES: (1)

- 1) Lateral braces to be a minimum of 2x4 SPF #2

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	11-0-10	-127	-127	---	FRONT	VERT	SNOW	---	C1
V	3-11-4	-77	-77	---	BACK	VERT	TOTAL	---	C1
W	5-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
Z	17-1-4	-100	-100	---	BACK	VERT	TOTAL	---	C1
AA	1-0-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
AB	1-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AC	3-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AD	5-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AE	7-11-4	-27	-27	---	BACK	VERT	TOTAL	---	C1
AF	9-1-4	-27	-27	---	BACK	VERT	TOTAL	---	C1
AG	10-0-8	-513	-513	---	BACK	VERT	TOTAL	---	C1
AH	16-0-8	-513	-513	---	BACK	VERT	TOTAL	---	C1
AI	17-1-4	-27	-27	---	BACK	VERT	TOTAL	---	C1
AJ	18-6-8	-1597	-1597	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (I) (INPUT = 0.90)


JSI METAL= 0.98 (E) (INPUT = 1.00)



Structural component only
DWG# T-2115238 *ml*

JOB NAME 410914	TRUSS NAME T9	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 13:22:21 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wimsz?k45-luYvBrLRmAVTOMy5AMyqoAUyiv5NgYslVFsyOyzEHcm

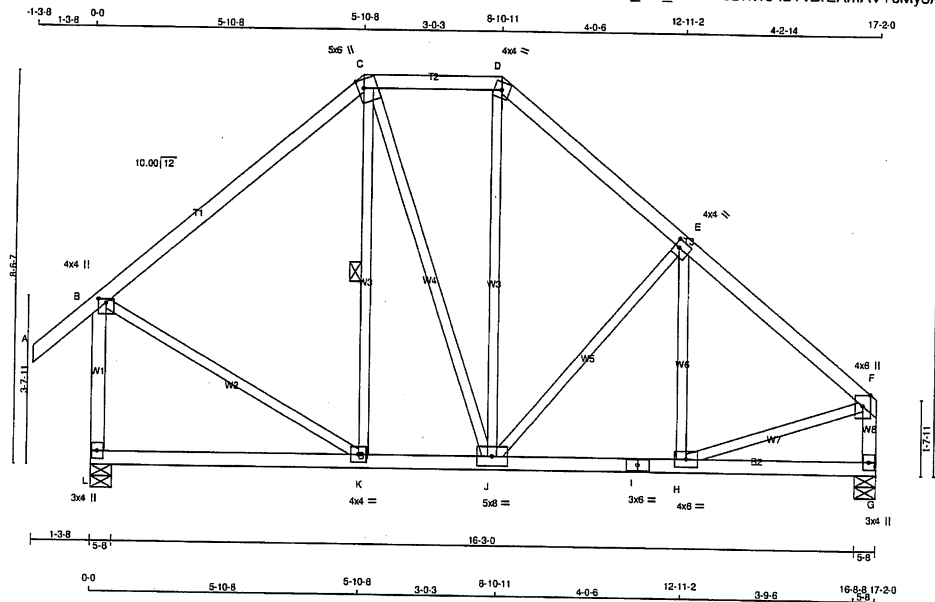

Scale = 1:45.7

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										TOTAL WEIGHT = 88 lb			
N. L. G. A. RULES														[M/F]			
CHORDS		SIZE	LUMBER	DESCR.	BEARINGS							DESIGN CRITERIA					
A - C	2x4	DRY	No.2	SPF	FACTORED			MAXIMUM FACTORED		INPUT	REQRD	SPECIFIED LOADS:					
C - D	2x4	DRY	No.2	SPF	GROSS REACTION			GROSS REACTION		BRG	BRG						
D - F	2x4	DRY	No.2	SPF	JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	TOP CH.	LL = 25.6	PSF		
L - B	2x4	DRY	No.2	SPF	L	1073	0	1073	0	0	5-8	5-8	DL = 6.0	PSF			
G - F	2x4	DRY	No.2	SPF	G	946	0	946	0	0	5-8	5-8	BOT CH.	LL = 0.0	PSF		
L - I	2x4	DRY	No.2	SPF											DL = 7.4	PSF	
I - G	2x4	DRY	No.2	SPF											TOTAL LOAD = 39.0	PSF	
					UNFACTORED REACTIONS										SPACING = 24.0 IN. C/C		
ALL WEBS 2x3 DRY No.2 SPF					1ST LCASE MAX./MIN. COMPONENT REACTIONS												

TOTAL WEIGHT = 88 lb [M/F]

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00
C TTWW+m	MT20	5.0	6.0	2.25	1.50
D TTW-m	MT20	4.0	4.0		
E TMVW-t	MT20	4.0	4.0	2.00	1.25
F TMVW+p	MT20	4.0	6.0	Edge	
G BMV1+p	MT20	3.0	4.0		
H BMVW-t	MT20	4.0	6.0		
I BS-t	MT20	3.0	6.0		
J BMVW-t	MT20	5.0	8.0		
K BMVW-t	MT20	4.0	4.0		
L BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES: (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED		MAX. UNIF. RAC LENGTH	MEMB.	MAX. FACTORED		
		VERT. LOAD (PLF)	LC1 CSI (LC)			MAX. FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM	TO		FR-TO			
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	K-C	-140 / 34	0.07 (1)
B-C	-592 / 0	-91.8	-91.8	0.41 (1)	6.25	C-J	0 / 120	0.03 (1)
C-D	-492 / 0	-91.8	-91.8	0.11 (1)	6.25	J-D	0 / 135	0.03 (4)
D-E	-671 / 0	-91.8	-91.8	0.20 (1)	6.25	J-E	-276 / 0	0.20 (1)
E-F	-843 / 0	-91.8	-91.8	0.21 (1)	6.25	H-E	-115 / 34	0.05 (1)
L-B	-1028 / 0	0.0	0.0	0.23 (1)	7.74	B-K	0 / 519	0.12 (1)
G-F	-914 / 0	0.0	0.0	0.10 (1)	7.81	H-F	0 / 701	0.16 (1)
L-K	0 / 0	-18.5	-18.5	0.14 (4)	10.00			
K-J	0 / 453	-18.5	-18.5	0.18 (4)	10.00			
J-I	0 / 670	-18.5	-18.5	0.15 (1)	10.00			
I-H	0 / 670	-18.5	-18.5	0.15 (1)	10.00			
H-G	0 / 0	-18.5	-18.5	0.08 (4)	10.00			

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.57")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.57")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.41/1.00 (B-C:1), BC=0.18/1.00 (J-K:4), WB=0.20/1.00 (E-J:1), SS=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.77 (B) (INPUT = 0.90)
JSI METAL= 0.40 (F) (INPUT = 1.00)



Structural component only
DWG# T-2115225

JOB NAME 410914	TRUSS NAME T10	QUANTITY 2	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

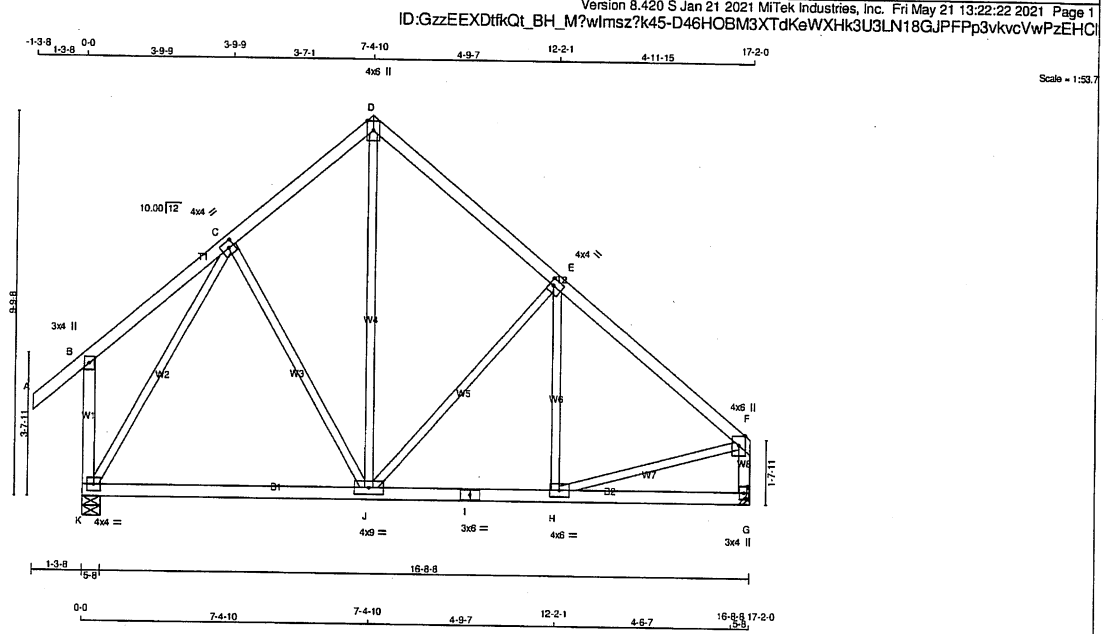

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
K - B	2x4	DRY	No.2
G - F	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	4.0	2.00	1.75
D	TTW+p	MT20	4.0	6.0	Edge	
E	TMWW-t	MT20	4.0	4.0	2.00	1.25
F	TMVW+p	MT20	4.0	6.0	Edge	
G	BMV1+p	MT20	3.0	4.0		
H	BMWW-t	MT20	4.0	6.0		
I	BS-t	MT20	3.0	6.0		
J	BMVW-t	MT20	4.0	9.0		
K	BMVW1-t	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES - (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
VERT				
K	1073	0	1073	0
G	946	0	946	0
			MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	757	510 / 0	0 / 0	0 / 0	0 / 0	247 / 0	0 / 0
G	669	439 / 0	0 / 0	0 / 0	0 / 0	230 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 41	-91.8 -91.8	0.13 (1)	10.00	C-J	-20 / 36	0.02 (1)
B-C	0 / 25	-91.8 -91.8	0.20 (1)	10.00	J-D	0 / 425	0.10 (1)
C-D	-585 / 0	-91.8 -91.8	0.16 (1)	6.25	J-E	-359 / 0	0.37 (1)
D-E	-596 / 0	-91.8 -91.8	0.29 (1)	6.25	H-E	-91 / 36	0.05 (1)
E-F	-833 / 0	-91.8 -91.8	0.29 (1)	6.25	K-C	-877 / 0	0.91 (1)
K-B	-259 / 0	0.0 0.0	0.06 (1)	7.81	H-F	0 / 689	0.16 (1)
G-F	-905 / 0	0.0 0.0	0.10 (1)	7.81			
K-J	0 / 440	-18.5 -18.5	0.24 (4)	10.00			
J-I	0 / 666	-18.5 -18.5	0.27 (4)	10.00			
I-H	0 / 666	-18.5 -18.5	0.27 (4)	10.00			
H-G	0 / 0	-18.5 -18.5	0.10 (4)	10.00			

TOTAL WEIGHT = 2 X 85 = 170 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.57")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.57")
CALCULATED VERT. DEFL.(TL) = L/999 (0.09")

CSI: TC=0.29/1.00 (E-F:1), BC=0.27/1.00 (H-J:4), WB=0.91/1.00 (C-K:1), SS=0.17/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.80 (C) (INPUT = 0.90)
JSI METAL= 0.41 (F) (INPUT = 1.00)




Structural component only
DWG# T-2115226

JOB NAME 410914	TRUSS NAME T11	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 13:22:23 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wimsz?k45-hHfcXNhinBFg6Tln?ibZK1imN8JP2zZL3TrzEHCK

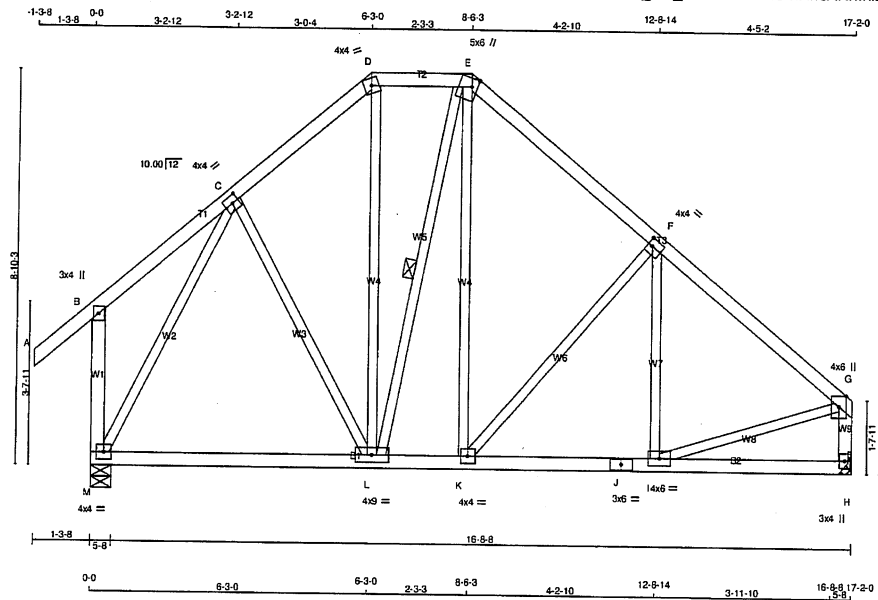

Scale = 1/4\"/>

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
E - G	2x4	DRY	No.2	SPF	
M - B	2x4	DRY	No.2	SPF	
H - G	2x4	DRY	No.2	SPF	
M - J	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	4.0	2.00	1.75
D	TTW-m	MT20	4.0	4.0		
E	TTWW+m	MT20	5.0	6.0	2.25	1.50
F	TMWW-t	MT20	4.0	4.0	2.00	1.25
G	TMVV+p	MT20	4.0	6.0	Edge	
H	BMV1+p	MT20	3.0	4.0		
I	BMWW-t	MT20	4.0	6.0		
J	BS-t	MT20	3.0	6.0		
K	BMWW-t	MT20	4.0	4.0		
L	BMWW-t	MT20	4.0	9.0		
M	BMVV1-t	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES: (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
M	1073	0	1073	0
H	946	0	946	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN	COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
M	757	510 / 0	0 / 0	0 / 0	0 / 0	247 / 0	0 / 0
H	669	439 / 0	0 / 0	0 / 0	0 / 0	230 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)
FR-TO					FR-TO			
A-B	0 / 41	-91.8	-91.8	0.13 (1)	C-L	0 / 65	0.02 (4)	
B-C	0 / 21	-91.8	-91.8	0.14 (1)	L-D	0 / 164	0.04 (1)	
C-D	-608 / 0	-91.8	-91.8	0.11 (1)	L-E	-100 / 0	0.05 (1)	
D-E	-451 / 0	-91.8	-91.8	0.06 (1)	K-E	0 / 245	0.06 (1)	
E-F	-648 / 0	-91.8	-91.8	0.22 (1)	K-F	-303 / 0	0.24 (1)	
F-G	-844 / 0	-91.8	-91.8	0.23 (1)	I-F	-101 / 43	0.04 (1)	
M-B	-240 / 0	0.0	0.0	0.05 (1)	M-C	-890 / 0	0.71 (1)	
H-G	-913 / 0	0.0	0.0	0.10 (1)	I-G	0 / 700	0.16 (1)	
M-L	0 / 418	-18.5	-18.5	0.20 (4)				
L-K	0 / 476	-18.5	-18.5	0.21 (4)				
K-J	0 / 671	-18.5	-18.5	0.16 (1)				
J-I	0 / 671	-18.5	-18.5	0.16 (1)				
I-H	0 / 0	-18.5	-18.5	0.09 (4)				

TOTAL WEIGHT = 95 lb

(M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.57")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.57")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.23/1.00 (F-G:1), BC=0.21/1.00 (K-L:4), WB=0.71/1.00 (C-M:1), SSI=0.15/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PL)
MAX	MIN	MAX
MT20	650	371
	1747	788
	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.78 (C) (INPUT = 0.90)
JSI METAL= 0.40 (G) (INPUT = 1.00)



Structural component only
DWG# T-2115227

JOB NAME 410914	TRUSS NAME T12S	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.420 S Jan 21 2021 MITek Industries, Inc. Fri May 21 13:22:24 2021 Page 1	

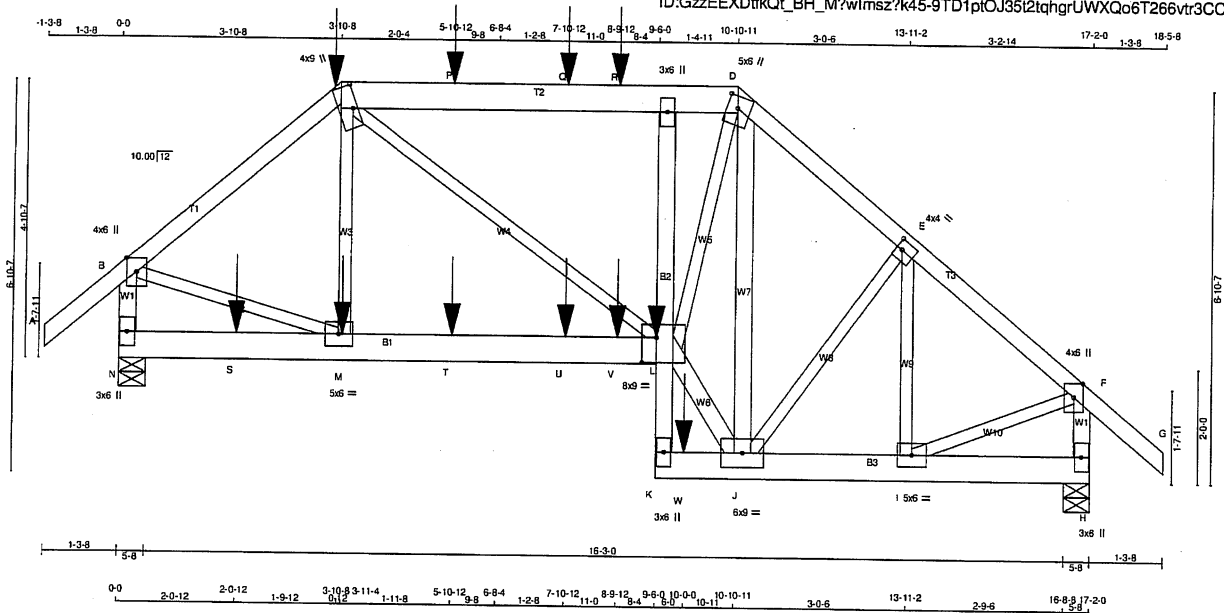

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410914	T12S	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MITek Industries, Inc. Fri May 21 13:22:24 2021 Page 2
ID:GzzEEXDtfkQt BH M?wImSz?k45-9TD1ptOJ35t2tghgrUWXQo6T266vtr3CCD5c?HzEHG

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	6.0	Edge	
C	TTWW+m	MT20	4.0	9.0	5.00	1.00
D	TTWW+m	MT20	5.0	6.0	2.50	2.25
E	TMVW-l	MT20	4.0	4.0	2.00	1.25
F	TMVW+p	MT20	4.0	6.0	Edge	
H	BMV1+p	MT20	3.0	6.0		
I	BMVW-l	MT20	5.0	6.0		
J	BMVWW-l	MT20	6.0	9.0		
K	NP+w	MT20	3.0	6.0		
L						
L	BVMVWW-l	MT20	8.0	9.0	5.25	3.00
M	BMVW-l	MT20	5.0	6.0		
N	BMV1+p	MT20	3.0	6.0		
O	NP+w	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.


NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2



Structural component only
DWG# T-2115228 *RL*

JOB NAME 410914	TRUSS NAME T13	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri May 21 13:22:25 2021 Page 1	

ID:GzzEEXDtfkQt_BH_M?wmsz?k45-dfnP1COxqO?vVzGsPB1mz?fg3WUzcNoLQtqAXkzEHCI

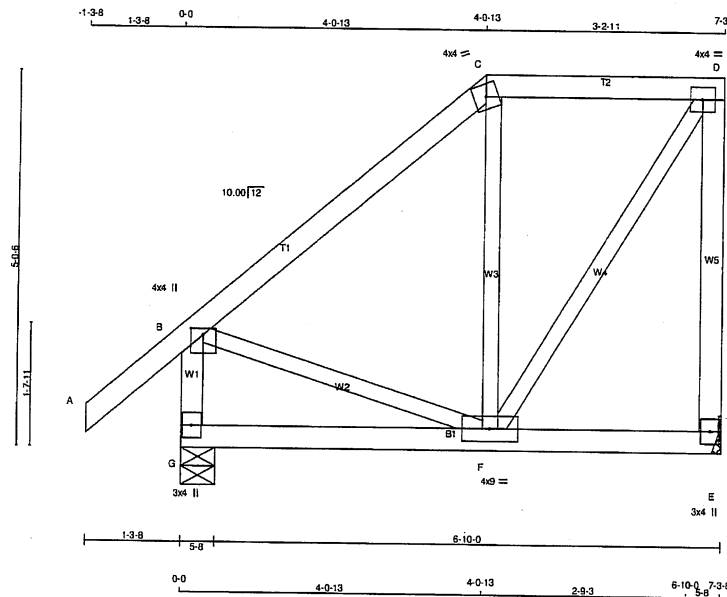

Scale = 1/28.2

TOTAL WEIGHT = 38 lb [M/F]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF
G - B	2x4	DRY	No.2	SPF
G - E	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)							
JT	TYPE	PLATES	W	LEN	Y	X	
B	TMVW+p	MT20	4.0	4.0	1.00	2.00	
C	TTW-m	MT20	4.0	4.0			
D	TMVW-t	MT20	4.0	4.0			
E	BMV1+p	MT20	3.0	4.0			
F	BMVWW-t	MT20	4.0	9.0			
G	BMV1+p	MT20	3.0	4.0			

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
E	402	0	402	0
G	529	0	529	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS	1ST LCASE	MAX./MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW
E	284	187 / 0
G	372	257 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. UNBRACED LENGTH FR-TO	MEMB. FORCE (LBS)
FR-TO		FROM TO		
A-B	0 / 41	-91.8 -91.8 0.13 (1)	10.00	F-C -202 / 0
B-C	-208 / 0	-91.8 -91.8 0.19 (1)	6.25	F-D 0 / 281
C-D	-155 / 0	-91.8 -91.8 0.12 (1)	6.25	B-F 0 / 167
E-D	-382 / 0	0.0 0.0 0.16 (1)	7.81	
G-B	-497 / 0	0.0 0.0 0.05 (1)	7.81	
G-F	0 / 0	-18.5 -18.5 0.07 (4)	10.00	
F-E	0 / 0	-18.5 -18.5 0.07 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.24")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.24")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.19/1.00 (B-C:1), BC=0.07/1.00 (F-G:4), WB=0.08/1.00 (C-F:1), SSI=0.12/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.39 (B) (INPUT = 0.90)
JSI METAL= 0.10 (B) (INPUT = 1.00)

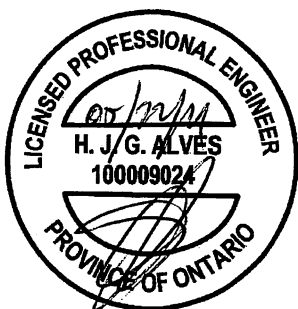

Structural component only
DWG# T-2115229

JOB NAME 410914	TRUSS NAME T14	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.420 S Jan 21 2021 MITek Industries, Inc. Fri May 21 13:22:26 2021 Page 1
ID:GzzEEXDtikQt_BH_M?wmsz?k45-5rLoEYPabi7m67/2zvY?VDBq9wpgLqFVfXaj3AzEHCh

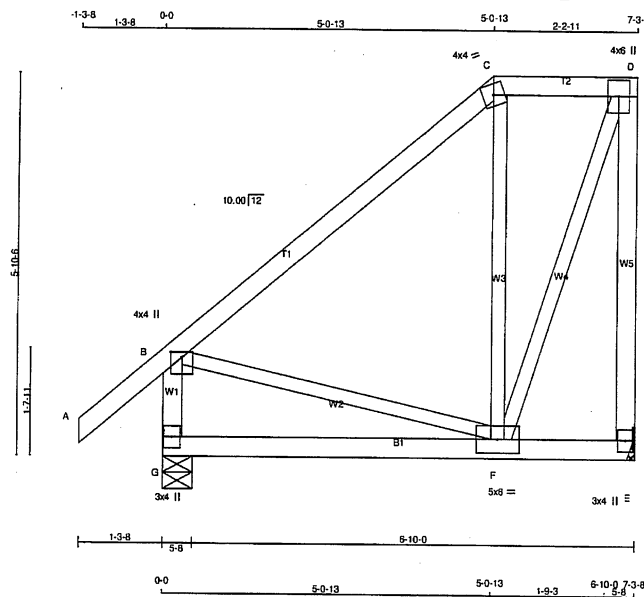

Scale: 3/8"=1'

TOTAL WEIGHT = 41 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF
G - B	2x4	DRY	No.2	SPF
G - E	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTW-m	MT20	4.0	4.0		
D	TMVW+p	MT20	4.0	6.0		
E	BMV1+p	MT20	3.0	4.0		
F	BMVWW-t	MT20	5.0	8.0		
G	BMV1+p	MT20	3.0	4.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
VERT	HORZ	DOWN	HORZ	UPLIFT
E	402	0	402	0
G	529	0	529	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
COMBINED	SNOW	LIVE				
E	284	187 / 0	0 / 0	0 / 0	98 / 0	0 / 0
G	372	257 / 0	0 / 0	0 / 0	114 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00	F-C	-236 / 0	0.13 (1)
B-C	-155 / 0	-91.8	-91.8 0.30 (1)	6.25	F-D	0 / 321	0.07 (1)
C-D	-112 / 0	-91.8	-91.8 0.06 (1)	6.25	B-F	0 / 122	0.03 (1)
E-D	-402 / 0	0.0	0.0 0.26 (1)	7.81			
G-B	-488 / 0	0.0	0.0 0.05 (1)	7.81			
G-F	0 / 0	-18.5	-18.5 0.11 (4)	10.00			
F-E	0 / 0	-18.5	-18.5 0.11 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.24")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.24")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.02")

CSI: TC=0.30/1.00 (B-C:1), BC=0.11/1.00 (F-G:4), WB=0.13/1.00 (C-F:1), SS=0.14/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.38 (B) (INPUT = 0.90)
JSI METAL= 0.10 (B) (INPUT = 1.00)



Structural component only
DWG# T-2115230

JOB NAME 410914	TRUSS NAME T15S	QUANTITY 2	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri May 21 13:22:27 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wlmz?k45-Z2vARuQCM0FdkHQFc3E2Qk2dKAb4HSeuBJGoczEHCg

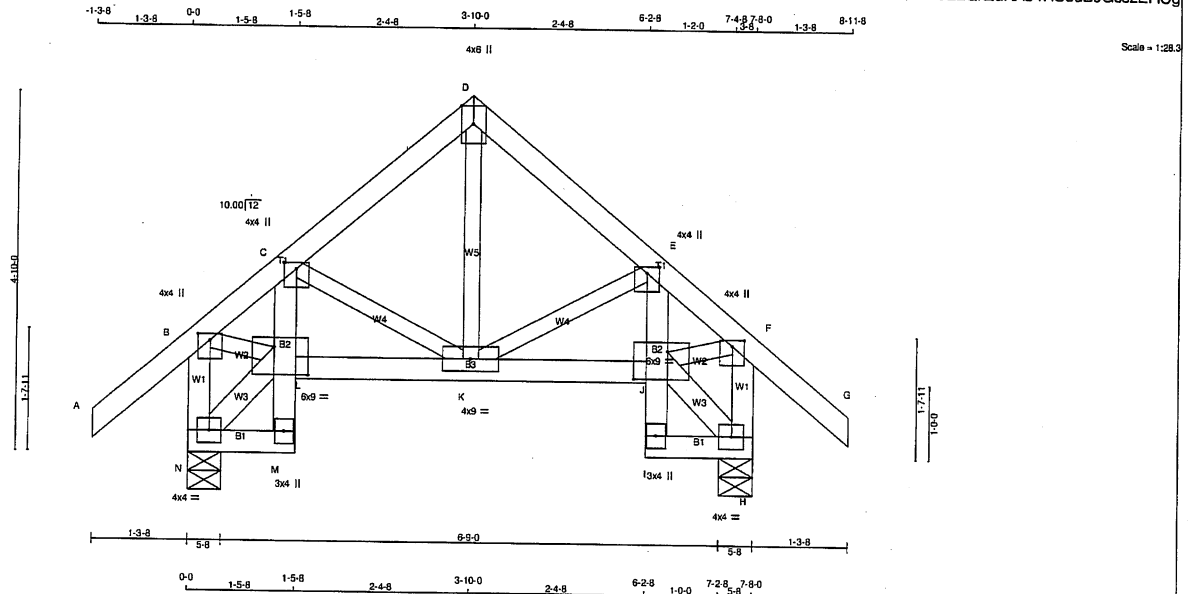

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2	
D - G	2x4	DRY	No.2	
N - B	2x4	DRY	No.2	
H - F	2x4	DRY	No.2	
N - M	2x4	DRY	No.2	
M - C	2x4	DRY	No.2	
L - J	2x4	DRY	No.2	
I - E	2x4	DRY	No.2	
I - H	2x4	DRY	No.2	
ALL WEBS	2x3	DRY	No.2	
EXCEPT				
N - L	2x4	DRY	No.2	
J - H	2x4	DRY	No.2	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B, C, E, F						
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
D	TTW+p	MT20	4.0	6.0	Edge	
H	BMVW-1	MT20	4.0	4.0		
I	BMV+p	MT20	3.0	4.0		
J	BMVWV-1	MT20	6.0	9.0	4.50	5.50
K	BMVWV-1	MT20	4.0	9.0		
L	BMVWV-1	MT20	6.0	9.0	4.50	5.50
M	BMV+p	MT20	3.0	4.0		
N	BMVWV-1	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES: (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	IN-SX	IN-SX
N	550	0	0	5-8
H	550	0	5-8	5-8

UNFACTORED REACTIONS	1ST LCASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
N	386	267 / 0	0 / 0
H	386	267 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD LC1	MAX	MAX.	MEMB.	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1	MAX	MAX.	MEMB.	FORCE (LBS)	MAX
FR-TO		FROM	TO	CS1 (LC)	UNBRAC	LENGTH	FR-TO
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	K-D	0 / 143
B-C	-391 / 0	-91.8	-91.8	0.09 (1)	6.25	K-E	-90 / 0
C-D	-281 / 0	-91.8	-91.8	0.07 (1)	6.25	C-K	-90 / 0
D-E	-281 / 0	-91.8	-91.8	0.07 (1)	6.25	N-L	-16 / 0
E-F	-391 / 0	-91.8	-91.8	0.09 (1)	6.25	B-L	0 / 286
F-G	0 / 41	-91.8	-91.8	0.13 (1)	10.00	J-H	-16 / 0
N-B	-528 / 0	0.0	0.0	0.06 (1)	7.81	J-F	0 / 286
H-F	-528 / 0	0.0	0.0	0.06 (1)	7.81		
N-M	0 / 13	-18.5	-18.5	0.01 (4)	10.00		
M-L	0 / 14	0.0	0.0	0.02 (1)	10.00		
L-C	-44 / 7	0.0	0.0	0.01 (1)	7.81		
L-K	0 / 288	-18.5	-18.5	0.06 (1)	10.00		
K-J	0 / 288	-18.5	-18.5	0.06 (1)	10.00		
I-J	0 / 14	0.0	0.0	0.02 (1)	10.00		
J-E	-44 / 7	0.0	0.0	0.01 (1)	7.81		
I-H	0 / 13	-18.5	-18.5	0.01 (4)	10.00		

TOTAL WEIGHT = 2 X 44 = 87 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPI 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.26")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.26")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CS1: TC=0.13/1.00 (F-G:1), BC=0.06/1.00 (K-L:1),
WB=0.06/1.00 (B-L:1), SS=0.08/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.46 (F) (INPUT = 0.90)
JSI METAL = 0.13 (F) (INPUT = 1.00)




Structural component only
DWG# T-2115231

JOB NAME 410914	TRUSS NAME T16	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 13:22:28 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wmsz?k45-1ETYfERq7JNUMR_R4KaTaeHDujSspEn6r3q82zEHCh

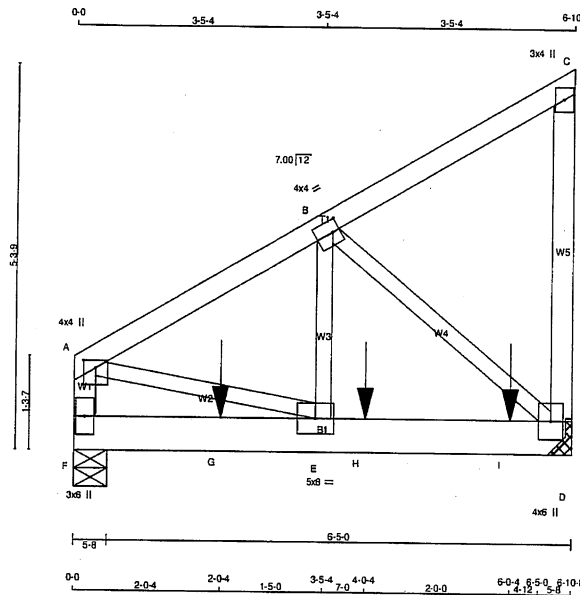

Scale = 1/28.9

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - A	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
D - C	2x4	DRY	No.2	SPF	
F - D	2x6	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F-A 1	12	TOP
A-C 1	12	TOP
C-D 1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F-D 2	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TMVW-t	MT20	4.0	4.0	2.00	1.25
C	TMV+p	MT20	3.0	4.0		
D	BMVW1+p	MT20	4.0	6.0		
E	BMVW-t	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
F	1535	0	1535	0
D	2008	0	2008	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN	COMPONENT REACTIONS
F	1083	723 / 0	0 / 0
D	1417	947 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS							
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)				
FR-TO		FROM	TO			FR-TO						
F-A	-1281 / 0	0.0	0.0	0.07 (1)	7.81	A-E	0 / 1417	0.18 (1)				
A-B	-1572 / 0	-91.8	-91.8	0.09 (1)	6.25	E-B	0 / 1576	0.20 (1)				
B-C	-16 / 0	-91.8	-91.8	0.08 (1)	6.25	B-D	-1793 / 0	0.29 (1)				
D-C	-126 / 0	0.0	0.0	0.03 (1)	7.81							
F-G	0 / 0	-18.5	-18.5	0.20 (1)	10.00							
G-E	0 / 0	-18.5	-18.5	0.20 (1)	10.00							
E-H	0 / 1372	-18.5	-18.5	0.32 (1)	10.00							
H-I	0 / 1372	-18.5	-18.5	0.32 (1)	10.00							
I-D	0 / 1372	-18.5	-18.5	0.32 (1)	10.00							

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	2-0-4	-654	-654	---	BACK	VERT	TOTAL	---	C1
H	4-0-4	-654	-654	---	BACK	VERT	TOTAL	---	C1
I	6-0-4	-656	-656	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 35 = 71 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.23")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.23")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CS1: TC=0.09/1.00 (A-B:1), BC=0.32/1.00 (D-E:1), WB=0.29/1.00 (B-D:1), SS=0.40/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.78 (A) (INPUT = 0.90)

JSI METAL= 0.31 (D) (INPUT = 1.00)



Structural component only
DWG# T-2115232/1/2

CONTINUED ON PAGE 2

JOB NAME 410914	TRUSS NAME T16	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 13:22:28 2021 Page 2
ID:GzzEEEXDtIkQt BH M?wImSz?k45-1ETyIFRq7JNUMR R4KaTaeHDuiSsphEn6r3q82zEHCf

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
F	BMV1+p	MT20	3.0	6.0	

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2




Structural component only
DWG# T-2115232 *212*

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410916	T16Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 14:57:46 2021 Page 1
ID:GzEEEXDtikQt_BH_M?wImSz?k45-cHzBkQeXWAn9LA7O2CAMKS5Oth_HZmMQzS9OrdzEFpJ

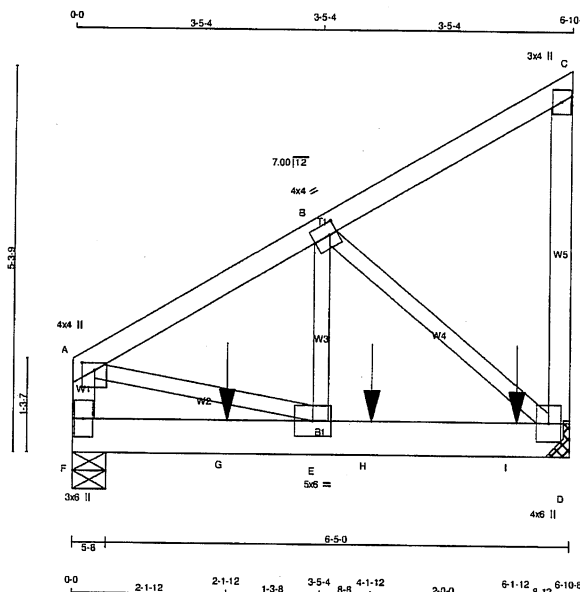

TOTAL WEIGHT = 2 X 35 = 71 lb [M]

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - A	2x4 DRY	No.2	SPF		
A - C	2x4 DRY	No.2	SPF		
D - C	2x4 DRY	No.2	SPF		
F - D	2x6 DRY	No.2	SPF		
ALL WEBS	2x3 DRY	No.2	SPF		
	DRY: SEASONED LUMBER.				

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122\"X3\") SPIRAL NAILS		
F - A 1 12		TOP
A - C 1 12		TOP
C - D 1 12		TOP
BOTTOM CHORDS : (0.122\"X3\") SPIRAL NAILS		
F - D 2 12		SIDE(0.0)
WEBS : (0.122\"X3\") SPIRAL NAILS		
2x3 1 6		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TMVW-t	MT20	4.0	4.0	2.00	1.25
C	TMV+p	MT20	3.0	4.0		
D	BMVW1+p	MT20	4.0	6.0		
E	BMVW-t	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	UPLIFT
F	1636	0	1636	0
D	2290	0	2290	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

1ST LCASE	MAX./MIN. COMPONENT REACTIONS
JT	COMBINED
F	1152
D	1612

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO							
F-A	-1391 / 0	0.0	0.0	0.08 (1)	7.81	A-E	0 / 1551
A-B	-1723 / 0	-91.8	-91.8	0.09 (1)	6.25	E-B	0 / 1762
B-C	-16 / 0	-91.8	-91.8	0.08 (1)	6.25	B-D	-1963 / 0
D-C	-126 / 0	0.0	0.0	0.03 (1)	7.81		
F-G	0 / 0	-18.5	-18.5	0.23 (1)	10.00		
G-E	0 / 0	-18.5	-18.5	0.23 (1)	10.00		
E-H	0 / 1502	-18.5	-18.5	0.34 (1)	10.00		
H-I	0 / 1502	-18.5	-18.5	0.34 (1)	10.00		
I-D	0 / 1502	-18.5	-18.5	0.34 (1)	10.00		

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	2-1-12	-742	-742	---	BACK	VERT	TOTAL	---	C1
H	4-1-12	-742	-742	---	BACK	VERT	TOTAL	---	C1
I	6-1-12	-744	-744	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6 PSF
	DL	= 6.0 PSF
BOT CH.	LL	= 0.0 PSF
	DL	= 7.4 PSF
TOTAL LOAD		= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.23")
CALCULATED VERT. DEFL.(LL)= L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.23")
CALCULATED VERT. DEFL.(TL)= L/999 (0.03")

CSI: TC=0.09/1.00 (A-B:1), BC=0.34/1.00 (D-E:1), WB=0.31/1.00 (B-D:1), SSI=0.42/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (A) (INPUT = 0.90)
JSI METAL= 0.34 (D) (INPUT = 1.00)



Structural component only
DWG# T-2115239 1/1

CONTINUED ON PAGE 2

JOB NAME 410916	TRUSS NAME T16Z	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES TRUSS DESC.	DRWG NO.
---------------------------	---------------------------	----------------------	-----------------	---	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 14:57:46 2021 Page 2
ID:GzzEEEXDtkQt BH M?wlmisz?k45-chzBkQeXWAn9LA7O2CAMKS5Oth HZmMQzS9OrdzEFpJ

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
F BMV1+p	MT20	3.0	6.0		

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2




Structural component only
DWG# T-2115239 *2/1*

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410916	T20	6	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 14:57:47 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wmsz?k45-5UXZyme9HUv0zKiacwhbfeWn5NpI60aC6vxN4zEFpI

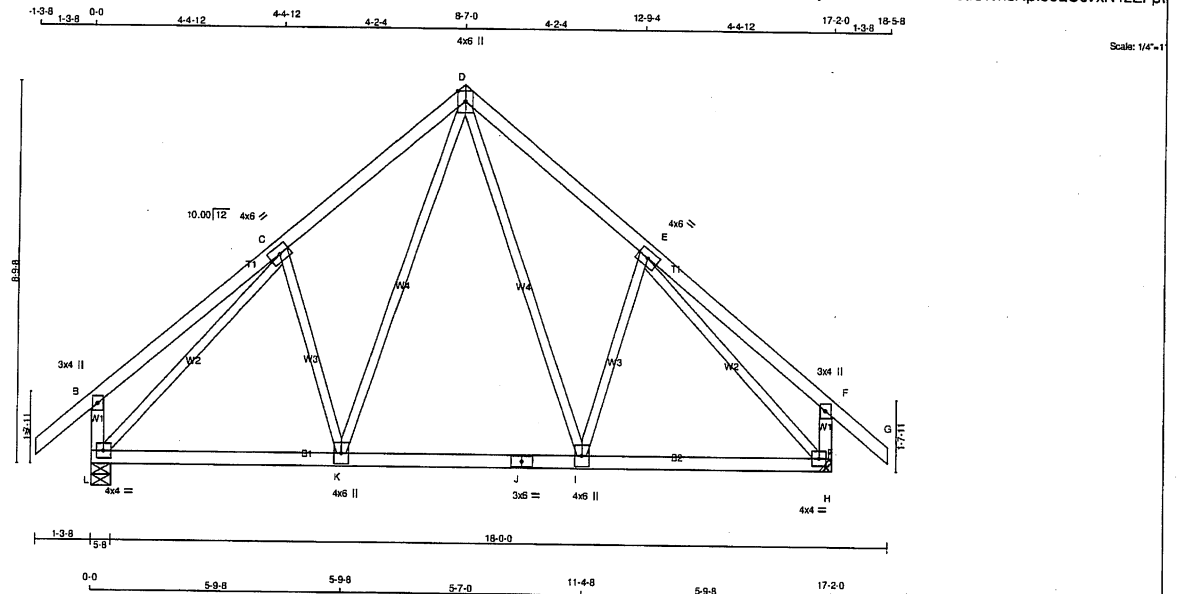

TOTAL WEIGHT = 6 X 84 = 504 lb
(M/F)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
L - B	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	6.0		
D	TTWW+p	MT20	4.0	6.0	Edge	
E	TMWW-t	MT20	4.0	6.0		
F	TMV+p	MT20	3.0	4.0		
H	BMVW1-t	MT20	4.0	4.0		
I	BMVW-t	MT20	4.0	6.0		
J	BS-t	MT20	3.0	6.0		
K	BMVW-t	MT20	4.0	6.0		
L	BMVW1-t	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
L	VERT 1073	DOWN 1073	0	5-8
H	HORIZ 0	UPLIFT 0	5-8	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
L	COMBINED	SNOW 510 / 0	LIVE 0 / 0	0 / 0	247 / 0	0 / 0
H	COMBINED	SNOW 510 / 0	LIVE 0 / 0	0 / 0	247 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00	D-I	0 / 356	0.08 (1)
B-C	0 / 30	-91.8	-91.8 0.27 (1)	10.00	I-E	-235 / 0	0.11 (1)
C-D	-797 / 0	-91.8	-91.8 0.22 (1)	6.25	K-D	0 / 356	0.08 (1)
D-E	-797 / 0	-91.8	-91.8 0.22 (1)	6.25	C-K	-235 / 0	0.11 (1)
E-F	0 / 30	-91.8	-91.8 0.27 (1)	10.00	L-C	-1003 / 0	0.74 (1)
F-G	0 / 41	-91.8	-91.8 0.13 (1)	10.00	E-H	-1003 / 0	0.74 (1)
L-B	-275 / 0	0.0	0.0 0.03 (1)	7.81			
H-F	-275 / 0	0.0	0.0 0.03 (1)	7.81			
L-K	0 / 661	-18.5	-18.5 0.19 (4)	10.00			
K-J	0 / 478	-18.5	-18.5 0.18 (4)	10.00			
J-I	0 / 478	-18.5	-18.5 0.18 (4)	10.00			
I-H	0 / 661	-18.5	-18.5 0.19 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015.

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.57")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.57")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.27/1.00 (E-F:1), BC=0.19/1.00 (H-I:1), WB=0.74/1.00 (E-H:1), SSI=0.15/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	650	371	1747
	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.77 (H) (INPUT = 0.90)
JSI METAL = 0.25 (E) (INPUT = 1.00)




Structural component only
DWG# T-2115240

JOB NAME 410916	TRUSS NAME T20S	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
---------------------------	---------------------------	----------------------	-----------------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MITek Industries, Inc. Fri May 21 14:57:48 2021 Page 1
ID:GzEEXDtkQt_BH_M?wimsz?k45-Zg5x96fn2n1tbUGnAdCqPtAiJUGZ1izjQmeVvWzEFpH

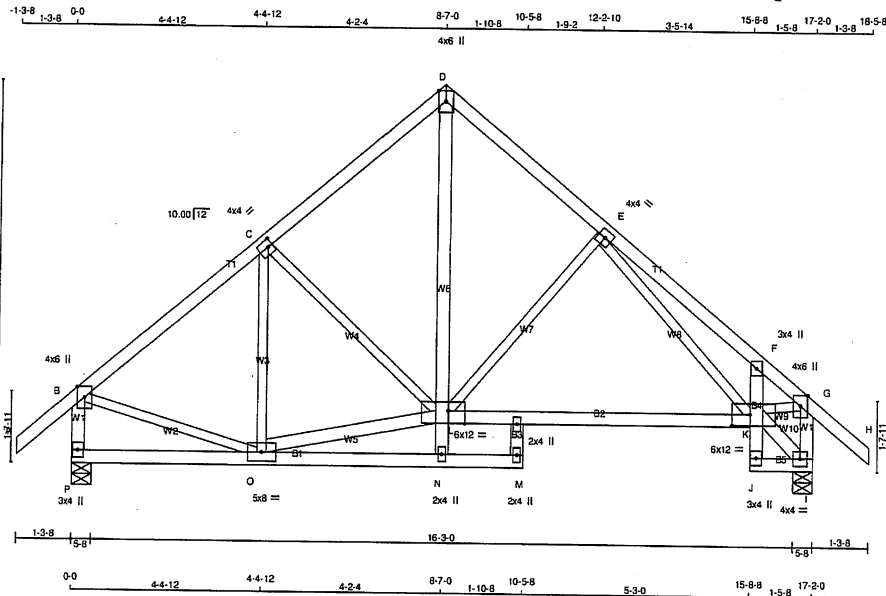

Scale: 1/4"=1'

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - H	2x4	DRY	No.2	SPF	
P - B	2x4	DRY	No.2	SPF	
I - G	2x4	DRY	No.2	SPF	
P - M	2x4	DRY	No.2	SPF	
L - K	2x4	DRY	No.2	SPF	
J - F	2x4	DRY	No.2	SPF	
J - I	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
N - D	2x4	DRY	No.2	SPF	
K - I	2x4	DRY	No.2	SPF	
O - L	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	6.0	Edge	
C	TMVW-t	MT20	4.0	4.0	2.00	1.25
D	TTW+p	MT20	4.0	6.0	Edge	
E	TMVW-t	MT20	4.0	4.0		
F	TMV+p	MT20	3.0	4.0		
G	TMVW+p	MT20	4.0	6.0	Edge	
I	BMVW1-t	MT20	4.0	4.0		
J	BMV+p	MT20	3.0	4.0		
K	BMVWW1-t	MT20	6.0	12.0	3.00	5.00
L	BMVWWWW1-t	MT20	6.0	12.0	Edge	4.50
M	NP+w	MT20	2.0	4.0		
N	BMVW+w	MT20	2.0	4.0		
O	BMVWW-t	MT20	5.0	8.0		
P	BMV1+p	MT20	3.0	4.0		
Q	NP+w	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES-

(1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REQD
JT	VERT	HORZ	DOWN	HORZ
P	1086	0	1086	0
I	1096	0	1096	0

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
P	767	507 / 0	0 / 0	0 / 0	0 / 0	260 / 0	0 / 0
I	774	513 / 0	0 / 0	0 / 0	0 / 0	261 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.05 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

MAX. UNBRACED INTERIOR CHORD LENGTH = 10.00 FT

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO						FR-TO			
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	O-C	-268 / 0	0.11 (1)	
B-C	-850 / 0	-91.8	-91.8	0.22 (1)	6.25	N-L	0 / 74	0.03 (4)	
C-D	-756 / 0	-91.8	-91.8	0.22 (1)	6.25	L-D	0 / 651	0.12 (1)	
D-E	-752 / 0	-91.8	-91.8	0.16 (1)	6.25	B-O	0 / 708	0.16 (1)	
E-F	-1005 / 0	-91.8	-91.8	0.16 (1)	6.06	K-I	-40 / 0	0.00 (1)	
F-G	-1041 / 0	-91.8	-91.8	0.10 (1)	6.05	K-G	0 / 795	0.18 (1)	
G-H	0 / 41	-91.8	-91.8	0.13 (1)	10.00	L-E	-319 / 0	0.18 (1)	
P-B	-1055 / 0	0.0	0.0	0.11 (1)	7.66	E-K	0 / 52	0.02 (4)	
I-G	-1060 / 0	0.0	0.0	0.11 (1)	7.64	O-L	0 / 691	0.11 (1)	
						C-L	-177 / 0	0.10 (1)	
P-O	0 / 0	-18.5	-18.5	0.09 (4)	10.00				
O-N	0 / 12	-18.5	-18.5	0.09 (4)	10.00				
N-M	0 / 0	-18.5	-18.5	0.08 (4)	10.00				
L-K	0 / 769	-18.5	-18.5	0.35 (4)	10.00				
J-K	0 / 14	0.0	0.0	0.05 (1)	10.00				
K-F	-147 / 0	0.0	0.0	0.03 (1)	7.81				
J-I	0 / 32	-18.5	-18.5	0.01 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.57")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.57")
CALCULATED VERT. DEFL.(TL) = L/999 (0.15")

CSI: TC=0.22/1.00 (B-C:1), BC=0.35/1.00 (K-L:4),
WB=0.19/1.00 (G-K:1), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	650	371	1747
	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (G) (INPUT = 0.90)
JSI METAL= 0.48 (G) (INPUT = 1.00)




Structural component only
DWG# T-2115241

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410916	T21S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MITek Industries, Inc. Fri May 21 14:57:49 2021 Page 1
ID:GzzEEXDthkQl_BH_M?wimsz?k45-1sfJMRgPp59KCDzjKj3y4jubu37mBCtQO2RyzEFpG

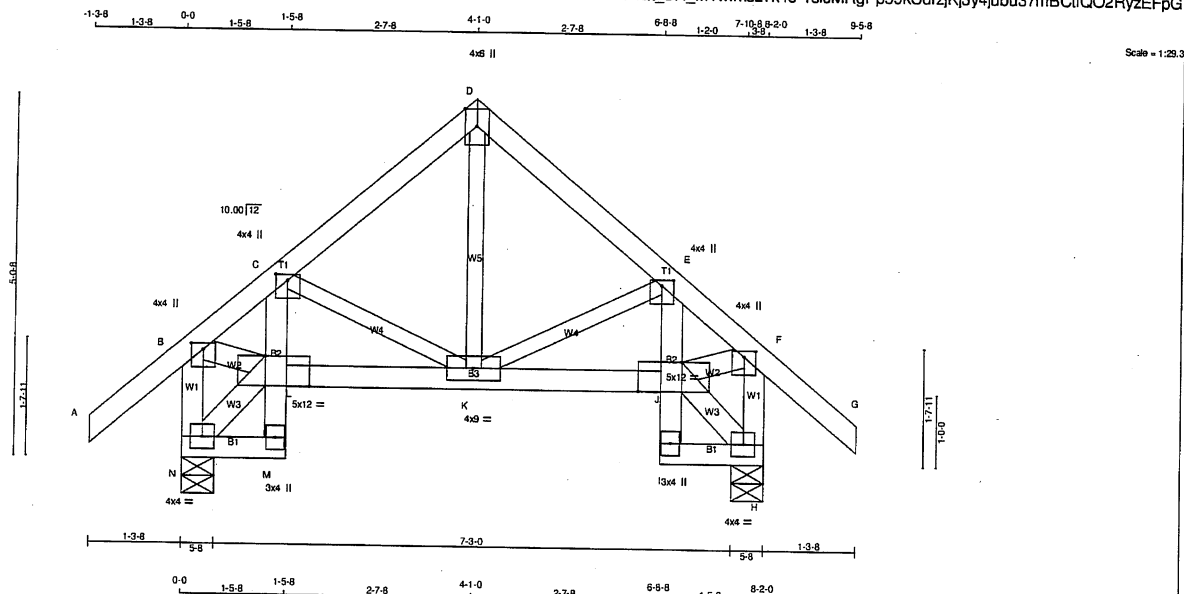

Scale = 1/2" = 1'-0"

TOTAL WEIGHT = 46 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2	
D - G	2x4	DRY	No.2	
N - B	2x4	DRY	No.2	
H - F	2x4	DRY	No.2	
N - M	2x4	DRY	No.2	
M - C	2x4	DRY	No.2	
L - J	2x4	DRY	No.2	
I - E	2x4	DRY	No.2	
I - H	2x4	DRY	No.2	
ALL WEBS	2x4	DRY	No.2	
EXCEPT				
K - D	2x3	DRY	No.2	
K - E	2x3	DRY	No.2	
C - K	2x3	DRY	No.2	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B, C, E, F						
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
D	TTW+p	MT20	4.0	6.0	Edge	
H	BMVW1-t	MT20	4.0	4.0		
I	BMV+p	MT20	3.0	4.0		
J	BMVWV-t	MT20	5.0	12.0	5.00	7.25
K	BMVWV-t	MT20	4.0	9.0		
L	BMVWV-t	MT20	5.0	12.0	5.00	7.25
M	BMV+p	MT20	3.0	4.0		
N	BMVW1-t	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES-

(1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	DOWN	IN-SX	IN-SX
N	577	0	5-8	5-8
H	577	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
N	406	280 / 0	0 / 0	0 / 0	0 / 0	0 / 0	126 / 0	0 / 0
H	406	280 / 0	0 / 0	0 / 0	0 / 0	0 / 0	126 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	UNBRACED LENGTH	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO						FR-TO			
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	K-D	0 / 157	0.04 (1)	
B-C	-430 / 0	-91.8	-91.8	0.09 (1)	6.25	K-E	-106 / 0	0.02 (1)	
C-D	-307 / 0	-91.8	-91.8	0.09 (1)	6.25	C-K	-106 / 0	0.02 (1)	
D-E	-307 / 0	-91.8	-91.8	0.09 (1)	6.25	N-L	-16 / 0	0.00 (1)	
E-F	-430 / 0	-91.8	-91.8	0.09 (1)	6.25	B-L	0 / 322	0.05 (1)	
F-G	0 / 41	-91.8	-91.8	0.13 (1)	10.00	J-H	-16 / 0	0.00 (1)	
N-B	-555 / 0	0.0	0.0	0.06 (1)	7.81	J-F	0 / 322	0.05 (1)	
H-F	-555 / 0	0.0	0.0	0.06 (1)	7.81				
N-M	0 / 13	-18.5	-18.5	0.01 (4)	10.00				
M-L	0 / 14	0.0	0.0	0.02 (1)	10.00				
L-C	-50 / 7	0.0	0.0	0.01 (1)	7.81				
L-K	0 / 322	-18.5	-18.5	0.07 (1)	10.00				
K-J	0 / 322	-18.5	-18.5	0.07 (1)	10.00				
I-J	0 / 14	0.0	0.0	0.02 (1)	10.00				
J-E	-50 / 7	0.0	0.0	0.01 (1)	7.81				
I-H	0 / 13	-18.5	-18.5	0.01 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.27")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.27")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.13/1.00 (F-G:1), BC=0.07/1.00 (K-L:1),
WB=0.05/1.00 (B-L:1), SS=0.09/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	650	371	1747
	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.50 (F) (INPUT = 0.90)
JSI METAL= 0.14 (F) (INPUT = 1.00)




Structural component only
DWG# T-2115242

JOB NAME 418940	TRUSS NAME T30	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MITek Industries, Inc. Fri May 21 15:29:32 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wlmssz?k45-pz8km8i5fowj04qiiVMKaO119?SB8mPzF_sFk9zEFLX

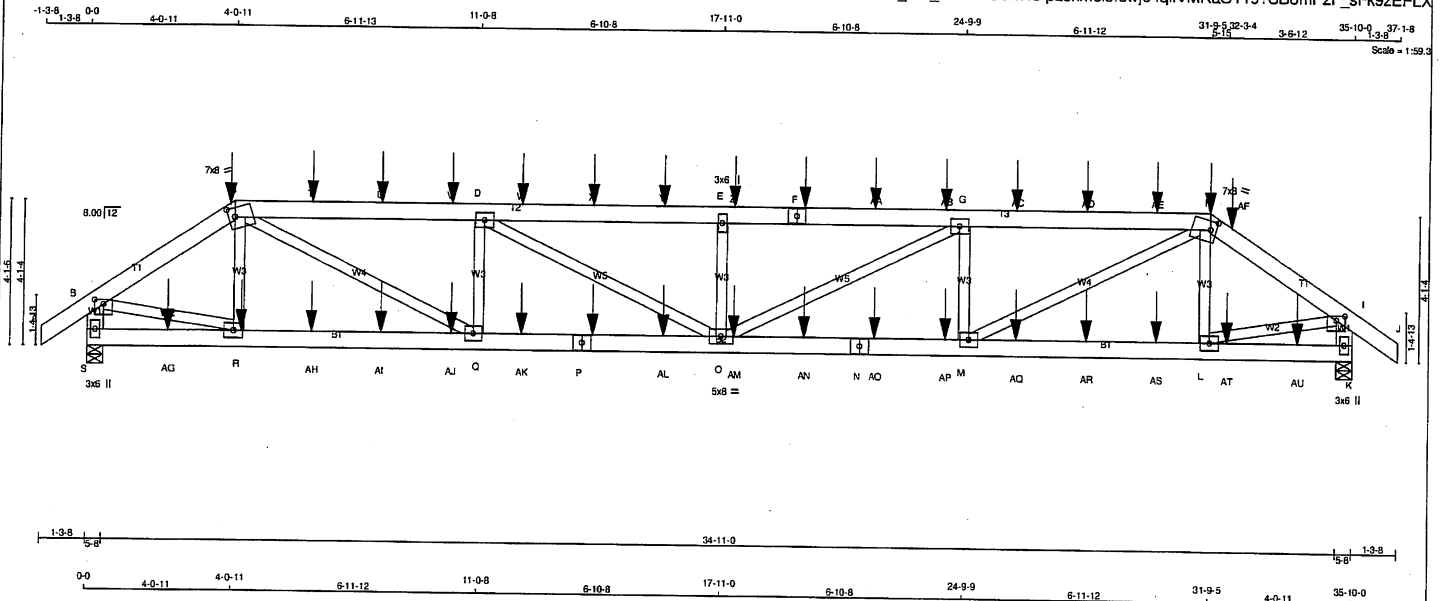

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.	BEARINGS				*** SPECIAL LOADS ANALYSIS ***			
A - C	2x6	DRY	No.2	FACTORED				GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.			
C - F	2x6	DRY	No.2	GROSS REACTION				LOADS WERE DERIVED FROM USER INPUT			
F - H	2x6	DRY	No.2	MAXIMUM FACTORED				NO FURTHER MODIFICATIONS WERE MADE			
H - J	2x6	DRY	No.2	INPUT							
S - B	2x6	DRY	No.2	REQRD							
K - I	2x6	DRY	No.2								
S - P	2x6	DRY	No.2								
P - N	2x6	DRY	No.2								
N - K	2x6	DRY	No.2								
ALL WEBS	2x4	DRY	No.2								
EXCEPT											

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	2	12
C-F	2	12
F-H	2	12
H-J	2	12
S-B	2	12
K-I	2	12
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S-P	2	12
P-N	2	12
N-K	2	12
WEBS : (0.122"x3") SPIRAL NAILS		
2x4	1	6

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

1ST LCASE	MAX./MIN.	COMPONENT REACTIONS
JT	COMBINED	SNOW
S	2442	1617 / 0
K	2479	1644 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.91 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD LC1	MAX	UNBRAC	MAX. FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1	CS1 (LC)	MAX	MEMB.	FORCE (LBS)	MAX	CS1 (LC)
FR-TO		FROM	TO	LENGTH	FR-TO			
A-B	0 / 36	-91.8	-91.8	0.04 (1)	10.00	R-C	-534 / 0	0.05 (1)
B-C	-4242 / 0	-91.8	-91.8	0.10 (1)	5.47	C-Q	0 / 4130	0.37 (1)
C-T	-7163 / 0	-91.8	-91.8	0.36 (1)	4.19	Q-D	-1702 / 0	0.15 (1)
T-U	-7163 / 0	-91.8	-91.8	0.36 (1)	4.19	D-O	0 / 1251	0.11 (1)
U-V	-7163 / 0	-91.8	-91.8	0.36 (1)	4.19	O-E	-944 / 0	0.08 (1)
V-D	-7163 / 0	-91.8	-91.8	0.36 (1)	4.19	E-G	0 / 1231	0.11 (1)
D-W	-8269 / 0	-91.8	-91.8	0.39 (1)	3.91	M-G	-1695 / 0	0.15 (1)
W-X	-8269 / 0	-91.8	-91.8	0.39 (1)	3.91	M-H	0 / 4112	0.36 (1)
X-Y	-8269 / 0	-91.8	-91.8	0.39 (1)	3.91	L-H	-538 / 0	0.05 (1)
Y-E	-8269 / 0	-91.8	-91.8	0.39 (1)	3.91	B-R	0 / 3599	0.32 (1)
E-Z	-8269 / 0	-91.8	-91.8	0.39 (1)	3.91	L-I	0 / 3633	0.32 (1)
Z-F	-8269 / 0	-91.8	-91.8	0.39 (1)	3.91			
F-AA	-8269 / 0	-91.8	-91.8	0.39 (1)	3.91			
AA-AB	-8269 / 0	-91.8	-91.8	0.39 (1)	3.91			
AB-G	-8269 / 0	-91.8	-91.8	0.39 (1)	3.91			
G-AC	-7180 / 0	-91.8	-91.8	0.36 (1)	4.19			
AC-AD	-7180 / 0	-91.8	-91.8	0.36 (1)	4.19			
AD-AE	-7180 / 0	-91.8	-91.8	0.36 (1)	4.19			
AE-H	-7180 / 0	-91.8	-91.8	0.36 (1)	4.19			
H-AF	-4253 / 0	-91.8	-91.8	0.11 (1)	5.45			
AF-I	-4253 / 0	-91.8	-91.8	0.11 (1)	5.45			
I-J	0 / 36	-91.8	-91.8	0.04 (1)	10.00			
S-B	-3434 / 0	0.0	0.0	0.12 (1)	7.53			
K-I	-3479 / 0	0.0	0.0	0.12 (1)	7.49			

S-AG	0 / 0	-18.5	-18.5	0.06 (4)	10.00
AG-R	0 / 0	-18.5	-18.5	0.06 (4)	10.00
R-AH	0 / 3498	-18.5	-18.5	0.27 (1)	10.00
AH-AI	0 / 3498	-18.5	-18.5	0.27 (1)	10.00
AI-AJ	0 / 3498	-18.5	-18.5	0.27 (1)	10.00
AJ-Q	0 / 3498	-18.5	-18.5	0.27 (1)	10.00
Q-AK	0 / 7164	-18.5	-18.5	0.53 (1)	10.00
AK-P	0 / 7164	-18.5	-18.5	0.53 (1)	10.00
P-AL	0 / 7164	-18.5	-18.5	0.53 (1)	10.00
AL-O	0 / 7164	-18.5	-18.5	0.53 (1)	10.00
O-AM	0 / 7181	-18.5	-18.5	0.53 (1)	10.00
AM-AN	0 / 7181	-18.5	-18.5	0.53 (1)	10.00
AN-N	0 / 7181	-18.5	-18.5	0.53 (1)	10.00
N-AO	0 / 7181	-18.5	-18.5	0.53 (1)	10.00
AO-AP	0 / 7181	-18.5	-18.5	0.53 (1)	10.00
AP-M	0 / 7181	-18.5	-18.5	0.53 (1)	10.00
M-AQ	0 / 3531	-18.5	-18.5	0.28 (1)	10.00
AQ-AR	0 / 3531	-18.5	-18.5	0.28 (1)	10.00



Structural component only
DWG# T-2115253

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.20")
ALLOWABLE DEFL.(TL) = L/360 (1.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.37")

CSI: TC=0.39/1.00 (D-E:1), BC=0.53/1.00 (M-O:1),
WB=0.37/1.00 (C-Q:1), SS=0.20/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (C) (INPUT = 0.90)
JSI METAL = 0.69 (P) (INPUT = 1.00)

CONTINUED ON PAGE 2

JOB NAME 418940	TRUSS NAME T30	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 15:29:32 2021 Page 2
ID:GzzEEXDtkQt BH M?wmsz?k45-pz8km8i5fowj04qiiVMKaO119?SB8mPzF sFk9zEFLX

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	6.0	1.50	3.00
C TTWW-m	MT20	7.0	8.0	3.00	2.00
D TMWW-t	MT20	5.0	6.0		
E TMW+w	MT20	3.0	6.0		
F TS-t	MT20	5.0	6.0		
G TMWW-t	MT20	5.0	6.0		
H TTWW-m	MT20	7.0	8.0	3.00	2.00
I TMVW-p	MT20	5.0	6.0	1.50	3.00
K BMV1+p	MT20	3.0	6.0		
L, M, Q, R					
L BMWW-t	MT20	5.0	6.0		
N BS-t	MT20	5.0	6.0		
O BMWW-t	MT20	5.0	6.0		
P BS-t	MT20	5.0	6.0		
S BMV1+p	MT20	3.0	6.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE	FACTORED	VERT. LOAD	MEMB.	FORCE	FACTORED	VERT. LOAD
(LBS)	(PLF)	LC1	MAX	(LBS)	(LBS)	LC1	MAX
FR-TO	FROM	TO	LENGTH	FR-TO	FROM	TO	LENGTH
AR-AS	0 / 3531	-18.5	-18.5 0.28 (1)	10.00			
AS-L	0 / 3531	-18.5	-18.5 0.28 (1)	10.00			
L-AT	0 / 0	-18.5	-18.5 0.07 (4)	10.00			
AT-AU	0 / 0	-18.5	-18.5 0.07 (4)	10.00			
AU-K	0 / 0	-18.5	-18.5 0.07 (4)	10.00			

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-11	-41	-41	---	FRONT	VERT	DEAD	---	C1
C	4-0-11	-81	-81	---	FRONT	VERT	TOTAL	---	C1
C	4-0-11	-173	-173	---	FRONT	VERT	SNOW	---	C1
F	20-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
H	31-9-5	-41	-41	---	FRONT	VERT	DEAD	---	C1
H	31-9-5	-173	-173	---	FRONT	VERT	SNOW	---	C1
P	14-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
R	4-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
T	6-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
U	8-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
V	10-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
W	12-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
X	14-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
Y	16-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
Z	18-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AA	22-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AB	24-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AC	26-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AD	28-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AE	30-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AF	32-3-4	-92	-92	---	FRONT	VERT	TOTAL	---	C1
AG	2-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AH	6-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AI	8-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AJ	10-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AK	12-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AL	16-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AM	18-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AN	20-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AO	22-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AP	24-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AQ	26-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AR	28-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AS	30-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AT	32-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AU	34-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2115253 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410918	T30S	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri Jun 4 09:44:44 2021 Page 1

ID:GzzEEEXDtKt BH_M?wmsz?k45-t6qWKpwsC2lyzNX4cGEbOuAc5fKwDM8Q8EVFU0z9j4n

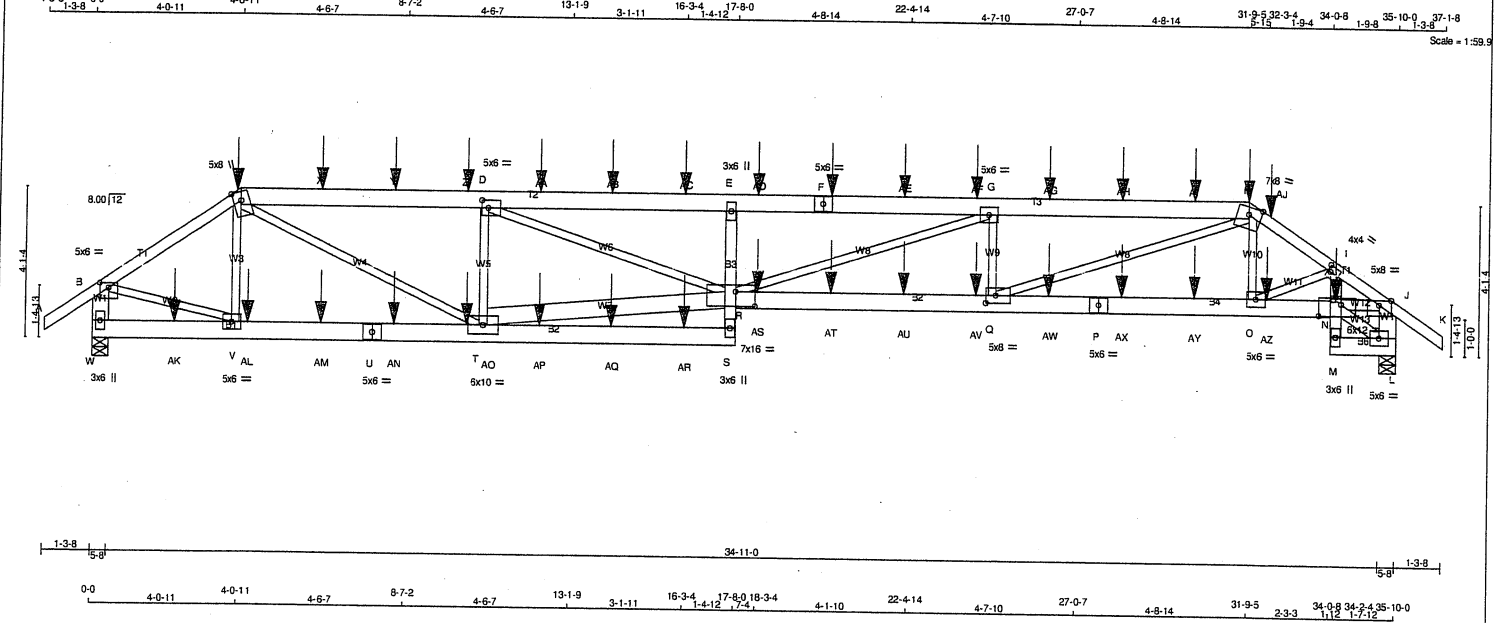

LUMBER				DESIGN CRITERIA			
N. L. G. A. RULES				*** SPECIAL LOADS ANALYSIS ***			
CHORDS	SIZE	LUMBER	DESCR.	GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.			
A - C	2x4	DRY	No.2	LOADS WERE DERIVED FROM USER INPUT			
C - F	2x6	DRY	No.2	NO FURTHER MODIFICATIONS WERE MADE			
F - H	2x6	DRY	No.2	SPECIFIED LOADS:			
H - K	2x4	DRY	No.2	TOP CH. LL = 25.6 PSF			
W - B	2x6	DRY	No.2	DL = 6.0 PSF			
L - J	2x6	DRY	No.2	BOT CH. LL = 0.0 PSF			
U - S	2x6	DRY	No.2	DL = 7.4 PSF			
S - P	2x4	DRY	No.2	TOTAL LOAD = 39.0 PSF			
P - N	2x6	DRY	No.2	SPACING = 24.0 IN. C/C			
N - L	2x4	DRY	No.2	LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12			
M - I	2x4	DRY	No.2	*** NON STANDARD GIRDER ***			
M - L	2x6	DRY	No.2	ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.			

ALL WEBS EXCEPT T - R 2x6 DRY No.2 SPF

T - R 2x6 DRY No.2 SPF

N - L 2x4 DRY No.2 SPF

N - J 2x4 DRY No.2 SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS SURFACE SPACING (IN) LOAD(PLF)

TOP CHORDS : (0.122"x3") SPIRAL NAILS

W - U 2 12 SIDE(183.1)

U - S 2 12 SIDE(0.0)

R - P 2 12 SIDE(0.0)

P - N 2 12 SIDE(61.0)

M - L 2 12 TOP

S - E 1 12 TOP

I - M 1 12 TOP

WEBS : (0.122"x3") SPIRAL NAILS

2x3 1 6

2x4 1 6

FR-TO MEMB. MAX. FORCE (LBS) FACTORED VERT. LOAD (PLF) MAX. UNBRACED LENGTH (FT) FR-TO MEMB. MAX. FORCE (LBS) FACTORED VERT. LOAD (PLF) MAX. UNBRACED LENGTH (FT)

A-B 0/35 -91.8 -91.8 0.07 (1) 10.00

B-C -4286 / 0 -91.8 -91.8 0.23 (1) 4.42

C-X -7437 / 0 -91.8 -91.8 0.37 (1) 4.11

X-Y -7437 / 0 -91.8 -91.8 0.37 (1) 4.11

Y-Z -7437 / 0 -91.8 -91.8 0.37 (1) 4.11

Z-D -7437 / 0 -91.8 -91.8 0.37 (1) 4.11

D-AA -12112 / 0 -91.8 -91.8 0.57 (1) 3.15

AA-AB -12112 / 0 -91.8 -91.8 0.57 (1) 3.15

AB-AC -12112 / 0 -91.8 -91.8 0.57 (1) 3.15

AC-E -12112 / 0 -91.8 -91.8 0.57 (1) 3.15

E-AD -12272 / 0 -91.8 -91.8 0.55 (1) 3.17

AD-F -12272 / 0 -91.8 -91.8 0.55 (1) 3.17

F-AE -12272 / 0 -91.8 -91.8 0.55 (1) 3.17

AE-AF -12272 / 0 -91.8 -91.8 0.55 (1) 3.17

AF-G -12272 / 0 -91.8 -91.8 0.55 (1) 3.17

G-AG -10927 / 0 -91.8 -91.8 0.51 (1) 3.36

AG-AH -10927 / 0 -91.8 -91.8 0.51 (1) 3.36

AH-AI -10927 / 0 -91.8 -91.8 0.51 (1) 3.36

AI-H -10927 / 0 -91.8 -91.8 0.51 (1) 3.36

H-AJ -6403 / 0 -91.8 -91.8 0.25 (1) 3.67

AJ-I -6403 / 0 -91.8 -91.8 0.25 (1) 3.67

I-J -6490 / 0 -91.8 -91.8 0.20 (1) 3.70

J-K 0/35 -91.8 -91.8 0.07 (1) 10.00

W-B -3575 / 0 0.0 0.0 0.13 (1) 7.42

L-J -3707 / 0 0.0 0.0 0.13 (1) 7.32

W-AK 0/0 -18.5 -18.5 0.05 (4) 10.00

AK-V 0/0 -18.5 -18.5 0.05 (4) 10.00

V-AL 0/3597 -18.5 -18.5 0.27 (1) 10.00

AL-AM 0/3597 -18.5 -18.5 0.27 (1) 10.00

AM-U 0/3597 -18.5 -18.5 0.27 (1) 10.00

U-AN 0/3597 -18.5 -18.5 0.27 (1) 10.00

AN-AO 0/3597 -18.5 -18.5 0.27 (1) 10.00

AO-T 0/3597 -18.5 -18.5 0.27 (1) 10.00

T-AP 0/424 -18.5 -18.5 0.10 (4) 10.00

AP-AQ 0/424 -18.5 -18.5 0.10 (4) 10.00

AQ-AR 0/424 -18.5 -18.5 0.10 (4) 10.00

AR-S 0/424 -18.5 -18.5 0.10 (4) 10.00

S-R 0/98 0.0 0.0 0.33 (1) 10.00

R-E -898 / 0 0.0 0.0 0.33 (1) 7.81

R-AS 0/10926 -18.5 -18.5 0.87 (1) 10.00

AS-AT 0/10926 -18.5 -18.5 0.87 (1) 10.00

AT-AU 0/10926 -18.5 -18.5 0.87 (1) 10.00

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019

- PART 9 OF CBC 2012 (2019 AMENDMENT)

- CSA 086-14

- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.19")

CALCULATED VERT. DEFL.(LL) = L/ 999 (0.40")

ALLOWABLE DEFL.(TL)= L/360 (1.19")

CALCULATED VERT. DEFL.(TL) = L/ 568 (0.76")

CSI: TC=0.57/1.00 (D-E:1), BC=0.87/1.00 (Q-R:1), WB=0.74/1.00 (H-Q:1), SSI=0.20/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.



Structural component only

DWG# T-2117653

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410918	T30S	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri Jun 4 09:44:44 2021 Page 2
ID:GzzEEEXDtKt BH M?Wlmsz?k45-t6qWKPwsC2IyzNX4cGEbOuAc5fKwDM8Q8EVFU0z9i4n

2x6 2 6
NAILS TO BE DRIVEN FROM ONE SIDE ONLY.
GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.50	3.00
C	TTWW+m	MT20	5.0	8.0	Edge	
D	TMVW-t	MT20	5.0	6.0		2.00
E	TMV+p	MT20	3.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMVW-t	MT20	5.0	6.0		
H	TTWW-m	MT20	7.0	8.0	Edge	
I	TMVW-t	MT20	4.0	4.0	2.00	1.00
J	TMVW-p	MT20	5.0	6.0	Edge	
L	BMVW1-t	MT20	5.0	6.0		
M	BMV+p	MT20	3.0	6.0		
N	BVMWV-l	MT20	6.0	12.0	3.75	7.50
O	BMVW-t	MT20	5.0	6.0		
P	BS-t	MT20	5.0	6.0		
Q	BMVW-t	MT20	5.0	8.0	2.50	3.25
R	BVMWVW-l	MT20	7.0	16.0	4.75	6.50
S	BMV+p	MT20	3.0	6.0		
T	BMVWVW-t	MT20	6.0	10.0		
U	BS-t	MT20	5.0	6.0		
V	BMVW-t	MT20	5.0	6.0		
W	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO	LENGTH	FR-TO		
AU-AV	0 / 10926	-18.5	-18.5	0.87 (1)	10.00		
AV-Q	0 / 10926	-18.5	-18.5	0.87 (1)	10.00		
Q-AW	0 / 5370	-18.5	-18.5	0.49 (1)	10.00		
AW-P	0 / 5370	-18.5	-18.5	0.49 (1)	10.00		
P-AX	0 / 5370	-18.5	-18.5	0.49 (1)	10.00		
AX-AY	0 / 5370	-18.5	-18.5	0.49 (1)	10.00		
AY-O	0 / 5370	-18.5	-18.5	0.49 (1)	10.00		
O-AZ	0 / 5578	-18.5	-18.5	0.51 (1)	10.00		
AZ-N	0 / 5578	-18.5	-18.5	0.51 (1)	10.00		
M-N	0 / 17	0.0	0.0	0.18 (1)	10.00		
N-I	0 / 60	0.0	0.0	0.19 (1)	10.00		
M-L	0 / 231	-18.5	-18.5	0.02 (1)	10.00		

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-11	-41	-41	---	FRONT	VERT	DEAD	---	C1
C	4-0-11	-81	-81	---	FRONT	VERT	TOTAL	---	C1
C	4-0-11	-173	-173	---	FRONT	VERT	SNOW	---	C1
F	20-3-4	-70	-70	---	FRONT	VERT	TOTAL	---	C1
H	31-9-5	-41	-41	---	FRONT	VERT	DEAD	---	C1
H	31-9-5	-173	-173	---	FRONT	VERT	SNOW	---	C1
N	34-2-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
X	6-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
Y	8-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
Z	10-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AA	12-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AB	14-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AC	16-3-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AD	18-3-4	-70	-70	---	FRONT	VERT	TOTAL	---	C1
AE	22-3-4	-70	-70	---	FRONT	VERT	TOTAL	---	C1
AF	24-3-4	-70	-70	---	FRONT	VERT	TOTAL	---	C1
AG	26-3-4	-70	-70	---	FRONT	VERT	TOTAL	---	C1
AH	28-3-4	-70	-70	---	FRONT	VERT	TOTAL	---	C1
AI	30-3-4	-70	-70	---	FRONT	VERT	TOTAL	---	C1
AJ	32-3-4	-86	-86	---	FRONT	VERT	TOTAL	---	C1
AK	2-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AL	4-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AM	6-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AN	8-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AO	10-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AP	12-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AQ	14-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AR	16-3-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AS	18-3-4	-73	-73	---	FRONT	VERT	TOTAL	---	C1
AT	20-3-4	-71	-71	---	FRONT	VERT	TOTAL	---	C1
AU	22-3-4	-71	-71	---	FRONT	VERT	TOTAL	---	C1
AV	24-3-4	-71	-71	---	FRONT	VERT	TOTAL	---	C1
AW	26-3-4	-71	-71	---	FRONT	VERT	TOTAL	---	C1
AX	28-3-4	-71	-71	---	FRONT	VERT	TOTAL	---	C1
AY	30-3-4	-71	-71	---	FRONT	VERT	TOTAL	---	C1
AZ	32-3-4	-71	-71	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.


JSI GRIP= 0.89 (V) (INPUT = 0.90)
JSI METAL= 0.74 (R) (INPUT = 1.00)



JOB NAME 410919	TRUSS NAME T30S1	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
---------------------------	----------------------------	----------------------	-----------------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri May 21 15:16:01 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wimsz?k45-3xe8YruNeckoDSKrigJ8CMyRN4e8xubmJvqmzfEFYC

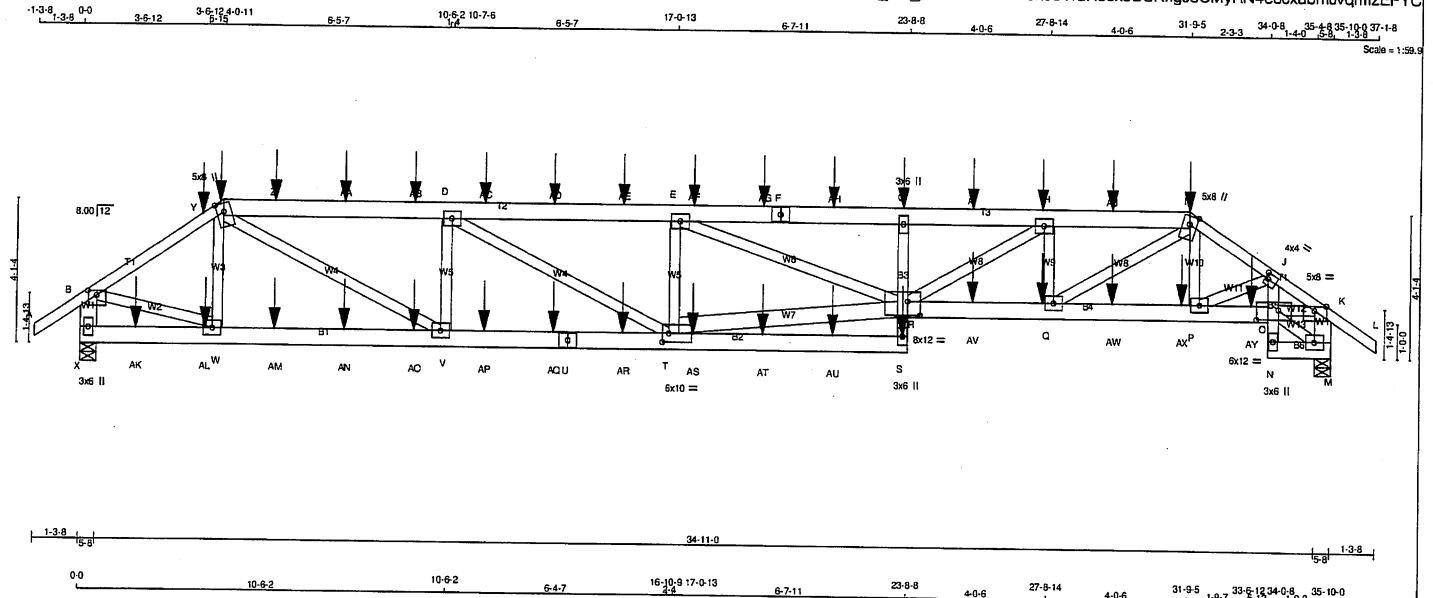

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. SPF TOTAL WEIGHT = 2 X 208 = 416 lb

CHORDS	SIZE	LUMBER	DESCR.	SPF
A - C	2x4	DRY	No.2	SPF
C - F	2x6	DRY	No.2	SPF
F - I	2x6	DRY	No.2	SPF
I - L	2x4	DRY	No.2	SPF
X - B	2x6	DRY	No.2	SPF
M - K	2x6	DRY	No.2	SPF
X - U	2x6	DRY	No.2	SPF
U - S	2x6	DRY	No.2	SPF
S - G	2x4	DRY	No.2	SPF
R - O	2x4	DRY	No.2	SPF
N - J	2x4	DRY	No.2	SPF
N - M	2x6	DRY	No.2	SPF
ALL WEBS	2x4	DRY	No.2	SPF
EXCEPT				
T - R	2x6	DRY	No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 1 12	SIDE(61.0)	
I - L 1 12	SIDE(61.0)	
C - F 2 12	SIDE(61.0)	
F - I 2 12	SIDE(183.1)	
X - B 2 12	TOP	
M - K 2 12	TOP	
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
X - U 2 12	SIDE(183.1)	
U - S 2 12	SIDE(122.0)	
R - O 2 12	SIDE(183.1)	
N - M 2 12	TOP	
S - G 1 12	TOP	
J - N 1 12	TOP	
WEBS : (0.122"x3") SPIRAL NAILS		
2x4 1 6		
2x6 2 6		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	IN-SX	IN-SX
X	3558 0	3558 0	5-8	5-8
M	3722 0	3722 0	5-8	5-8

UNFACTORED REACTIONS	1ST LCASE	MAX./MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
X	2513	1667 / 0 0 / 0 0 / 0 846 / 0 0 / 0
M	2628	1745 / 0 0 / 0 0 / 0 883 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) X, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.50 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	MAX	CS1 (LC)	MAX. UNBRAC	FR-TO	MEMB.	MAX. FACTORED	MAX	CS1 (LC)
MEMB.	FORCE (LBS)	(PLF)	(PLF)	(LBS)	(LBS)	LENGTH			FORCE (LBS)	(LBS)	
A-B	0 / 35	-91.8	-91.8	0.07 (1)	10.00	W-C	-889 / 0	0.06 (1)			
B-Y	-4160 / 0	-91.8	-91.8	0.25 (1)	4.44	R-H	0 / 2618	0.23 (1)			
Y-C	-4160 / 0	-91.8	-91.8	0.25 (1)	4.44	Q-H	-2038 / 0	0.13 (1)			
C-Z	-7096 / 0	-91.8	-91.8	0.30 (1)	4.27	Q-I	0 / 4094	0.36 (1)			
Z-AA	-7096 / 0	-91.8	-91.8	0.30 (1)	4.27	P-I	0 / 309	0.03 (1)			
AA-AB	-7096 / 0	-91.8	-91.8	0.30 (1)	4.27	P-J	-320 / 0	0.02 (1)			
AB-D	-7096 / 0	-91.8	-91.8	0.30 (1)	4.27	B-W	0 / 3607	0.32 (1)			
D-AC	-8500 / 0	-91.8	-91.8	0.35 (1)	3.92	O-M	-263 / 0	0.02 (1)			
AC-AD	-8500 / 0	-91.8	-91.8	0.35 (1)	3.92	O-K	0 / 5120	0.45 (1)			
AD-AE	-8500 / 0	-91.8	-91.8	0.35 (1)	3.92	T-E	-1811 / 0	0.16 (1)			
AE-E	-8500 / 0	-91.8	-91.8	0.35 (1)	3.92	T-R	0 / 8330	0.54 (1)			
E-AF	-10530 / 0	-91.8	-91.8	0.42 (1)	3.50	E-R	0 / 2104	0.19 (1)			
AF-AG	-10530 / 0	-91.8	-91.8	0.42 (1)	3.50	D-T	0 / 1617	0.14 (1)			
AG-F	-10530 / 0	-91.8	-91.8	0.42 (1)	3.50	C-V	0 / 4117	0.36 (1)			
F-AH	-10530 / 0	-91.8	-91.8	0.42 (1)	3.50	V-D	-1863 / 0	0.16 (1)			
AH-G	-10530 / 0	-91.8	-91.8	0.42 (1)	3.50						
G-AI	-10659 / 0	-91.8	-91.8	0.29 (1)	3.60						
AI-H	-10659 / 0	-91.8	-91.8	0.29 (1)	3.60						
H-AJ	-8448 / 0	-91.8	-91.8	0.22 (1)	4.04						
AJ-I	-8448 / 0	-91.8	-91.8	0.22 (1)	4.04						
I-J	-6017 / 0	-91.8	-91.8	0.22 (1)	3.81						
J-K	-6213 / 0	-91.8	-91.8	0.20 (1)	3.78						
K-L	0 / 35	-91.8	-91.8	0.07 (1)	10.00						
X-B	-3528 / 0	0.0	0.0	0.13 (1)	7.46						
M-K	-3565 / 0	0.0	0.0	0.13 (1)	7.42						

X-AK	0 / 0	-18.5	-18.5	0.06 (4)	10.00
AK-AL	0 / 0	-18.5	-18.5	0.06 (4)	10.00
AL-W	0 / 0	-18.5	-18.5	0.06 (4)	10.00
W-AM	0 / 3523	-18.5	-18.5	0.28 (1)	10.00
AM-AN	0 / 3523	-18.5	-18.5	0.28 (1)	10.00
AN-AO	0 / 3523	-18.5	-18.5	0.28 (1)	10.00
AO-V	0 / 3523	-18.5	-18.5	0.28 (1)	10.00
V-AP	0 / 7095	-18.5	-18.5	0.51 (1)	10.00
AP-AQ	0 / 7095	-18.5	-18.5	0.51 (1)	10.00
AQ-U	0 / 7095	-18.5	-18.5	0.51 (1)	10.00
U-AR	0 / 7095	-18.5	-18.5	0.51 (1)	10.00
AR-T	0 / 7095	-18.5	-18.5	0.51 (1)	10.00
T-AS	0 / 341	-18.5	-18.5	0.09 (4)	10.00
AS-AT	0 / 341	-18.5	-18.5	0.09 (4)	10.00
AT-AU	0 / 341	-18.5	-18.5	0.09 (4)	10.00
AU-S	0 / 341	-18.5	-18.5	0.09 (4)	10.00
S-R	0 / 116	0.0	0.0	0.27 (1)	10.00

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.26")
ALLOWABLE DEFL.(TL) = L/360 (1.19")
CALCULATED VERT. DEFL.(TL) = L/882 (0.49")

CSI: TC=0.42/1.00 (E-G:1), BC=0.61/1.00 (Q-R:1),
WB=0.54/1.00 (R-T:1), SS=0.19/1.00 (E-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

CONTINUED ON PAGE 2



Structural component only
DWG# T-2115247

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410919	T30S1	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MITek Industries, Inc. Fri May 21 15:16:01 2021 Page 2
ID:GzzEEXDtKt BH M?wmsz?k45-3xe8YruNeckoDSKrigJBCMyRN4e8cxubmJvqmfrzEFYC

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.50	3.00
C	TTWW+m	MT20	5.0	8.0	Edge	
D, E, H						
D	TMVW-t	MT20	5.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMV-p	MT20	3.0	6.0		
I	TTWW+m	MT20	5.0	8.0	Edge	
J	TMVW-t	MT20	4.0	4.0	2.00	1.00
K	TMVW-p	MT20	5.0	8.0	Edge	
M	BMVW-t	MT20	5.0	6.0		
N	BMV-p	MT20	3.0	6.0		
O	BVMWW-I	MT20	6.0	12.0	3.25	7.50
P, Q, V, W						
P	BMVW-t	MT20	5.0	6.0		
R	BVMWWW-I	MT20	8.0	12.0	4.75	4.25
S	BMV-p	MT20	3.0	6.0		
T	BVMWW-t	MT20	6.0	10.0	3.00	2.25
U	BS-t	MT20	5.0	6.0		
X	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES: (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX. FACTORED (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED (LC)	
FR-TO		FROM TO		LENGTH FR-TO			
R-G	-742 / 0	0.0	0.0	0.26 (1)	7.81		
R-AV	0 / 8447	-18.5	-18.5	0.61 (1)	10.00		
AV-Q	0 / 8447	-18.5	-18.5	0.61 (1)	10.00		
Q-AW	0 / 5035	-18.5	-18.5	0.39 (1)	10.00		
AW-AX	0 / 5035	-18.5	-18.5	0.39 (1)	10.00		
AX-P	0 / 5035	-18.5	-18.5	0.39 (1)	10.00		
P-AY	0 / 5341	-18.5	-18.5	0.37 (1)	10.00		
AY-O	0 / 5341	-18.5	-18.5	0.37 (1)	10.00		
N-O	0 / 17	0.0	0.0	0.18 (1)	10.00		
O-J	0 / 209	0.0	0.0	0.19 (1)	10.00		
N-M	0 / 222	-18.5	-18.5	0.02 (1)	10.00		

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-11	-41	-41	---	FRONT	VERT	DEAD	---	C1
C	4-0-11	-173	-173	---	FRONT	VERT	TOTAL	---	C1
G	23-6-12	-76	-76	---	BACK	VERT	DEAD	---	C1
H	27-6-12	-73	-73	---	BACK	VERT	TOTAL	---	C1
I	31-9-5	-41	-41	---	FRONT	VERT	DEAD	---	C1
I	31-9-5	-78	-78	---	BACK	VERT	TOTAL	---	C1
I	31-9-5	-173	-173	---	FRONT	VERT	SNOW	---	C1
Q	27-6-12	-68	-68	---	BACK	VERT	TOTAL	---	C1
S	23-6-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
Y	3-6-12	-92	-92	---	BACK	VERT	TOTAL	---	C1
Z	5-6-12	-76	-76	---	BACK	VERT	TOTAL	---	C1
AA	7-6-12	-76	-76	---	BACK	VERT	TOTAL	---	C1
AB	9-6-12	-76	-76	---	BACK	VERT	TOTAL	---	C1
AC	11-6-12	-76	-76	---	BACK	VERT	TOTAL	---	C1
AD	13-6-12	-76	-76	---	BACK	VERT	TOTAL	---	C1
AE	15-6-12	-76	-76	---	BACK	VERT	TOTAL	---	C1
AF	17-6-12	-76	-76	---	BACK	VERT	TOTAL	---	C1
AG	19-6-12	-76	-76	---	BACK	VERT	TOTAL	---	C1
AH	21-6-12	-76	-76	---	BACK	VERT	TOTAL	---	C1
AI	25-6-12	-73	-73	---	BACK	VERT	TOTAL	---	C1
AJ	29-6-12	-73	-73	---	BACK	VERT	TOTAL	---	C1
AK	1-6-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
AL	3-6-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
AM	5-6-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
AN	7-6-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
AO	9-6-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
AP	11-6-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
AQ	13-6-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
AR	15-6-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
AS	17-6-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
AT	19-6-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
AU	21-6-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
AV	25-6-12	-68	-68	---	BACK	VERT	TOTAL	---	C1
AW	29-6-12	-68	-68	---	BACK	VERT	TOTAL	---	C1
AX	31-6-12	-68	-68	---	BACK	VERT	TOTAL	---	C1
AY	33-6-12	-71	-71	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

JSI GRIP= 0.89 (T) (INPUT = 0.90)
JSI METAL= 0.66 (U) (INPUT = 1.00)




Structural component only
DWG# T-2115247 *4/2*

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410918	T31	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MITek Industries, Inc. Fri Jun 4 09:44:46 2021 Page 1
ID:GzzEEXDtKQt_BH_M?wlmSz?k45-pVyHl5y6kfyGdghTkhG3TJFsnS4chL8icY_MYuz9j4

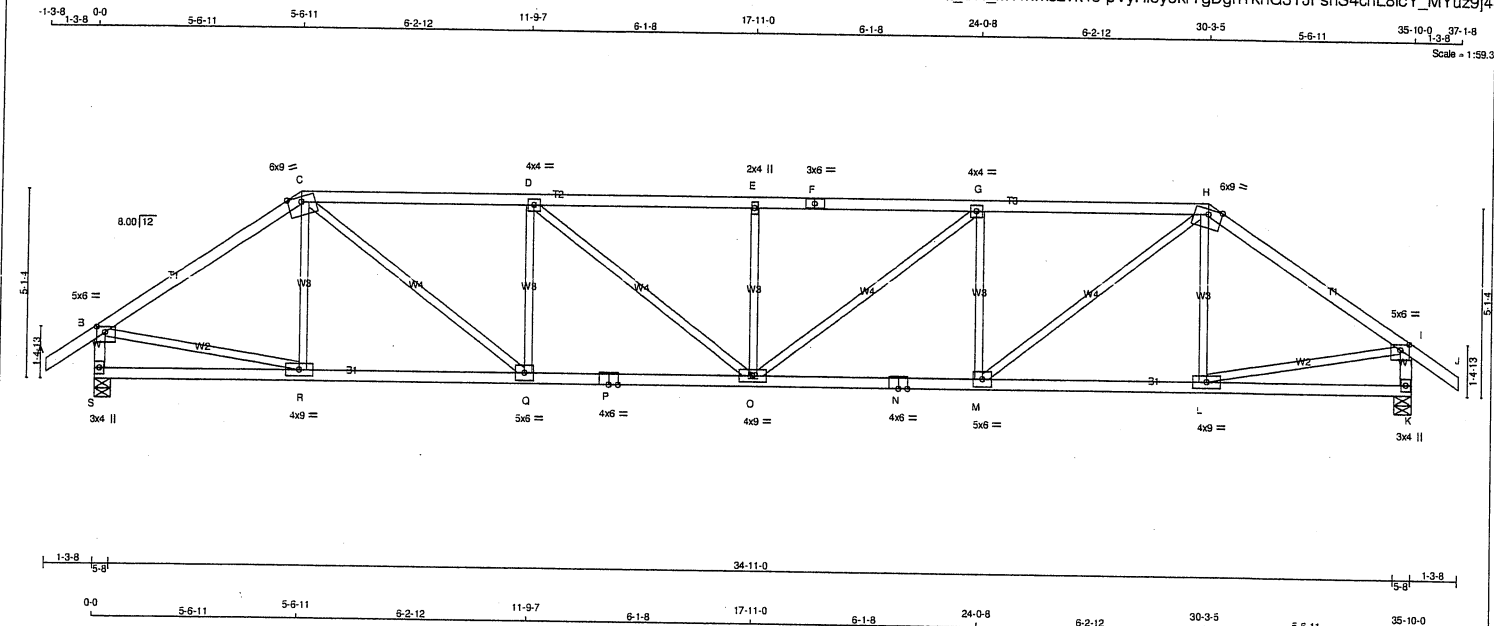

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
S - B	2x4	DRY	No.2
K - I	2x4	DRY	No.2
S - P	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2

ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW-p	MT20	5.0	6.0 1.75 2.75
C	TTWW-m	MT20	6.0	9.0 Edge
D	TMVW-t	MT20	4.0	4.0
E	TMVW-w	MT20	2.0	4.0
F	TS-t	MT20	3.0	6.0
G	TMVW-t	MT20	4.0	4.0
H	TTWW-m	MT20	6.0	9.0 Edge
I	TMVW-p	MT20	5.0	6.0 1.75 2.75
K	BMV1+p	MT20	3.0	4.0
L	BMVW-t	MT20	4.0	9.0
M	BMVW-t	MT20	5.0	6.0
N	BS-t	MT20	4.0	6.0
O	BMVW-t	MT20	4.0	9.0
P	BS-t	MT20	4.0	6.0
Q	BMVW-t	MT20	5.0	6.0
R	BMVW-t	MT20	4.0	9.0
S	BMV1+p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES: (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REQD
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
S	2101	0	2101	0	5-8
K	2101	0	2101	0	5-8

UNFACTORED REACTIONS		1ST LCASE	MAX/MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
S	1484	987 / 0	0 / 0	0 / 0	0 / 0	497 / 0	0 / 0		
K	1484	987 / 0	0 / 0	0 / 0	0 / 0	497 / 0	0 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.83 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8 -91.8	0.12 (1)	10.00	R-C	-249 / 9	0.10 (1)
B-C	-2349 / 0	-91.8 -91.8	0.71 (1)	3.74	C-Q	0 / 1745	0.39 (1)
C-D	-3329 / 0	-91.8 -91.8	0.87 (1)	3.06	Q-D	-955 / 0	0.37 (1)
D-E	-3731 / 0	-91.8 -91.8	0.94 (1)	2.83	D-O	0 / 511	0.12 (1)
E-F	-3731 / 0	-91.8 -91.8	0.94 (1)	2.83	O-E	-519 / 0	0.20 (1)
F-G	-3731 / 0	-91.8 -91.8	0.94 (1)	2.83	O-G	0 / 511	0.12 (1)
G-H	-3329 / 0	-91.8 -91.8	0.87 (1)	3.06	M-G	-955 / 0	0.37 (1)
H-I	-2349 / 0	-91.8 -91.8	0.71 (1)	3.74	M-H	0 / 1745	0.39 (1)
I-J	0 / 35	-91.8 -91.8	0.12 (1)	10.00	L-H	-249 / 9	0.10 (1)
S-B	-2060 / 0	0.0 0.0	0.21 (1)	5.89	B-R	0 / 1987	0.45 (1)
K-I	-2060 / 0	0.0 0.0	0.21 (1)	5.89	L-I	0 / 1987	0.45 (1)
S-R	0 / 0	-18.5 -18.5	0.15 (4)	10.00			
R-Q	0 / 1947	-18.5 -18.5	0.40 (1)	10.00			
Q-P	0 / 3329	-18.5 -18.5	0.60 (1)	10.00			
P-O	0 / 3329	-18.5 -18.5	0.60 (1)	10.00			
O-N	0 / 3329	-18.5 -18.5	0.60 (1)	10.00			
N-M	0 / 3329	-18.5 -18.5	0.60 (1)	10.00			
M-L	0 / 1947	-18.5 -18.5	0.40 (1)	10.00			
L-K	0 / 0	-18.5 -18.5	0.15 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 240 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.19")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.22")
ALLOWABLE DEFL.(TL)= L/360 (1.19")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.42")

CSI: TC=0.94/1.00 (D-E:1) , BC=0.60/1.00 (M-O:1) ,
WB=0.45/1.00 (L-L:1) , SS=0.27/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (I) (INPUT= 0.90)
JSI METAL= 0.76 (P) (INPUT= 1.00)




Structural component only
DWG# T-2117654

JOB NAME 410918	TRUSS NAME T31S	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
---------------------------	---------------------------	----------------------	-----------------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri Jun 4 09:44:47 2021 Page 1
ID:GzzEEXDtikQt_BH_M?wimsz?k45-lhWfyRyKvZhXqqGflOnl0Xo37sODQmdsrCjv4Lz9j4k

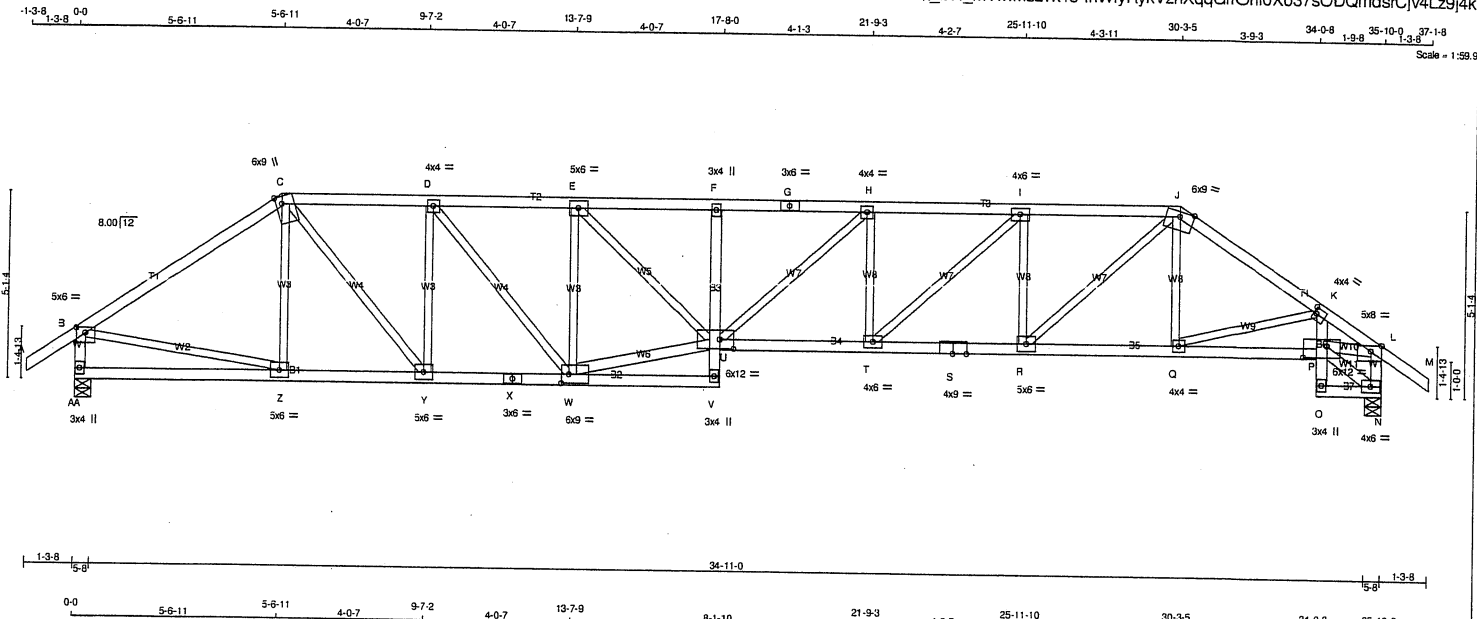

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - G	2x4	DRY	No.2	SPF	
G - J	2x4	DRY	No.2	SPF	
J - M	2x4	DRY	No.2	SPF	
AA - B	2x4	DRY	No.2	SPF	
N - L	2x4	DRY	No.2	SPF	
AA - X	2x4	DRY	No.2	SPF	
X - V	2x4	DRY	No.2	SPF	
V - F	2x4	DRY	No.2	SPF	
U - S	2x4	DRY	No.2	SPF	
S - P	2x4	DRY	No.2	SPF	
O - K	2x4	DRY	No.2	SPF	
O - N	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
W - U	2x4	DRY	No.2	SPF	
P - N	2x4	DRY	No.2	SPF	
P - L	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
AA	2099	0	2104	0	0
N	2104	0	2104	0	0

UNFACTORED REACTIONS		MAX/MIN. COMPONENT REACTIONS	
JT	1ST LCASE	SNOW	LIVE
AA	1482	986 / 0	0 / 0
N	1485	988 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) AA, N
BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.97 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.
 ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO	FROM TO	FR-TO	FROM TO
A-B	0 / 35	A-B	0 / 35
B-C	-2342 / 0	B-C	-2342 / 0
C-D	-2919 / 0	C-D	-2919 / 0
D-E	-3474 / 0	D-E	-3474 / 0
E-F	-4622 / 0	E-F	-4622 / 0
F-G	-4652 / 0	F-G	-4652 / 0
G-H	-4652 / 0	G-H	-4652 / 0
H-I	-4443 / 0	H-I	-4443 / 0
I-J	-3728 / 0	I-J	-3728 / 0
J-K	-2928 / 0	J-K	-2928 / 0
K-L	-3414 / 0	K-L	-3414 / 0
L-M	0 / 35	L-M	0 / 35
AA-B	-2055 / 0	AA-B	-2055 / 0
N-L	-2009 / 0	N-L	-2009 / 0
AA-Z	0 / 0	AA-Z	0 / 0
Z-Y	0 / 1941	Z-Y	0 / 1941
Y-X	0 / 2919	Y-X	0 / 2919
X-W	0 / 2919	X-W	0 / 2919
W-V	0 / 114	W-V	0 / 114
V-U	0 / 33	V-U	0 / 33
U-F	-370 / 0	U-F	-370 / 0
U-T	0 / 4443	U-T	0 / 4443
T-S	0 / 3728	T-S	0 / 3728
S-R	0 / 3728	S-R	0 / 3728
R-Q	0 / 2432	R-Q	0 / 2432
Q-P	0 / 2953	Q-P	0 / 2953
O-P	0 / 17	O-P	0 / 17
P-K	0 / 177	P-K	0 / 177
O-N	0 / 114	O-N	0 / 114

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 086-14
 - TPIC 2014

DESIGN ASSUMPTIONS
 - OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.19")
 CALCULATED VERT. DEFL.(LL)= L/999 (0.30")
 ALLOWABLE DEFL.(TL)= L/360 (1.19")
 CALCULATED VERT. DEFL.(TL)= L/764 (0.56")

CSI: TC=0.71/1.00 (B-C:1), BC=0.77/1.00 (T-U:1), WB=0.56/1.00 (U-W:1), SSI=0.18/1.00 (J-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (W) (INPUT = 0.90)
 JSI METAL= 0.87 (X) (INPUT = 1.00)



Structural component only
 DWG# T-2117655

JOB NAME 410918	TRUSS NAME T31S	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES TRUSS DESC.	DRWG NO.
---------------------------	---------------------------	----------------------	-----------------	---	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri Jun 4 09:44:47 2021 Page 2
ID:GzzEEXDtkQt BH M?wlmsz?k45-lhWfyRykVzhXqqGflOnl0Xo37sODQmdsrCjv4Lz9j4k

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
U	BMWWWW-I	MT20	6.0	12.0	3.00	4.50
V	BMV+p	MT20	3.0	4.0		
W	BMWWWW-t	MT20	6.0	9.0	3.00	2.50
X	BS-t	MT20	3.0	6.0		
AA	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2




Structural component only
DWG# T-2117655 *TH*

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410919	T31S1	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri May 21 15:18:02 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wlmisz?k45-X8BWmAu0Pwtfrv1FoQnlaUV2UzoLnlj?zfOJ6zEFYB

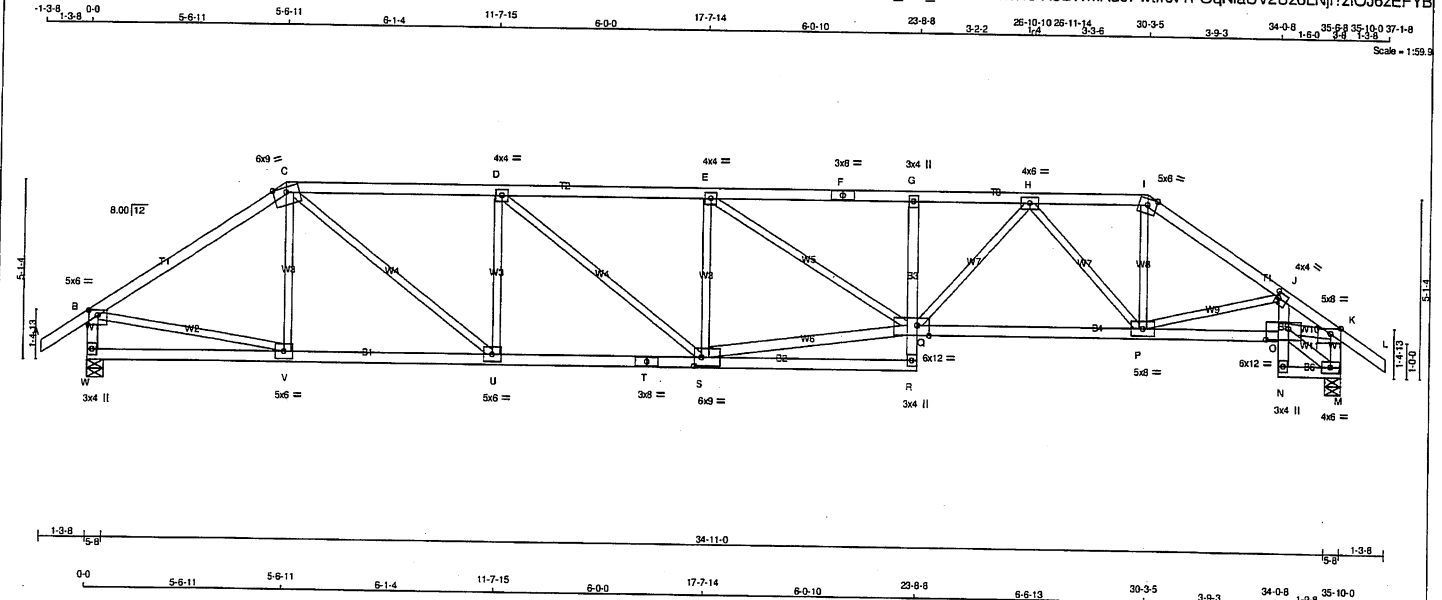

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - F	2x4	DRY	No.2	SPF	
F - I	2x4	DRY	No.2	SPF	
I - L	2x4	DRY	No.2	SPF	
W - B	2x4	DRY	No.2	SPF	
M - K	2x4	DRY	No.2	SPF	
W - T	2x4	DRY	No.2	SPF	
T - R	2x4	DRY	No.2	SPF	
R - G	2x4	DRY	No.2	SPF	
Q - O	2x4	DRY	No.2	SPF	
N - J	2x4	DRY	No.2	SPF	
N - M	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	
S - Q	2x4	DRY	No.2	SPF	
O - M	2x4	DRY	No.2	SPF	
O - K	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	3.00
C	TTWW-m	MT20	6.0	9.0	Edge	
D	TMVW-t	MT20	4.0	4.0		
E	TMVW-t	MT20	4.0	4.0		
F	TS-t	MT20	3.0	8.0		
G	TMV-p	MT20	3.0	4.0		
H	TMVW-t	MT20	4.0	6.0		
I	TTW-m	MT20	5.0	6.0	Edge	
J	TMVW-t	MT20	4.0	4.0	2.00	1.00
K	BMVW-p	MT20	5.0	8.0	Edge	3.50
M	BMVW-t	MT20	4.0	6.0		
N	BMV-p	MT20	3.0	4.0		
O	BVMW-W	MT20	6.0	12.0	3.75	7.75
P	BMVW-W	MT20	5.0	8.0		
Q	BVMW-W	MT20	6.0	12.0	Edge	4.00
R	BMV-p	MT20	3.0	4.0		
S	BMVW-W	MT20	6.0	9.0	3.00	2.50
T	BS-t	MT20	3.0	8.0		
U	BMVW-t	MT20	5.0	6.0		
V	BMVW-t	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	DOWN	UP	IN-SX
W	2099	0	0	5-8
M	2104	0	0	5-8

UNFACTORED REACTIONS

	1ST LCASE	MAX. MIN. COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
W	1482	986 / 0	0 / 0	0 / 0	0 / 0	496 / 0
M	1485	988 / 0	0 / 0	0 / 0	0 / 0	497 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) W, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.87 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)
FR-TO					FR-TO			
A-B	0 / 35	-91.8	-91.8	0.12 (1)	V-C	-248 / 9	0.10 (1)	
B-C	-2346 / 0	-91.8	-91.8	0.71 (1)	S-E	-828 / 0	0.32 (1)	
C-D	-3298 / 0	-91.8	-91.8	0.81 (1)	S-Q	0 / 3656	0.59 (1)	
D-E	-3727 / 0	-91.8	-91.8	0.88 (1)	E-Q	0 / 514	0.12 (1)	
E-F	-4173 / 0	-91.8	-91.8	0.82 (1)	Q-H	0 / 1143	0.26 (1)	
F-G	-4173 / 0	-91.8	-91.8	0.82 (1)	H-P	-1495 / 0	0.63 (1)	
G-H	-4209 / 0	-91.8	-91.8	0.48 (1)	P-I	0 / 1313	0.30 (1)	
H-I	-2494 / 0	-91.8	-91.8	0.23 (1)	I-J	-533 / 0	0.16 (1)	
I-J	-2935 / 0	-91.8	-91.8	0.36 (1)	J-K	0 / 1985	0.45 (1)	
J-K	-3410 / 0	-91.8	-91.8	0.24 (1)	K-L	-138 / 0	0.01 (1)	
K-L	0 / 35	-91.8	-91.8	0.12 (1)	L-M	0 / 2823	0.45 (1)	
L-M	-2057 / 0	0.0	0.0	0.21 (1)	M-N	0 / 553	0.12 (1)	
M-N	-2010 / 0	0.0	0.0	0.21 (1)	N-O	0 / 1723	0.39 (1)	
N-O	0 / 0	-18.5	-18.5	0.15 (4)	O-P	-963 / 0	0.37 (1)	
O-P	0 / 1944	-18.5	-18.5	0.40 (1)	P-Q			
P-Q	0 / 3298	-18.5	-18.5	0.61 (1)	Q-R			
Q-R	0 / 3298	-18.5	-18.5	0.61 (1)	R-S			
R-S	0 / 136	-18.5	-18.5	0.17 (4)	S-T			
S-T	0 / 50	0.0	0.0	0.19 (1)	T-U			
T-U	-441 / 0	0.0	0.0	0.20 (1)	U-V			
U-V	0 / 3458	-18.5	-18.5	0.85 (1)	V-W			
V-W	0 / 2948	-18.5	-18.5	0.56 (1)	W-X			
W-X	0 / 17	0.0	0.0	0.18 (1)	X-Y			
X-Y	0 / 169	0.0	0.0	0.20 (1)	Y-Z			
Y-Z	0 / 114	-18.5	-18.5	0.03 (1)	Z-A			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.25")
ALLOWABLE DEFL.(TL) = L/360 (1.19")
CALCULATED VERT. DEFL.(TL) = L/866 (0.50")

CSI: TC=0.88/1.00 (D-E:1), BC=0.85/1.00 (P-Q:1),
WB=0.63/1.00 (H-P:1), SS=0.26/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (V) (INPUT = 0.90)
JSI METAL= 0.98 (T) (INPUT = 1.00)



Structural component only
DWG# T-2115248 1/2


CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.														
410919	T31S1	1	1	TRUSS DESC.																
Tamarack Roof Truss, Burlington																				
Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 15:16:02 2021 Page 2 ID:GzzEEXDtrkQt BH M?wImSz?k45-X8BWmAu0Pwtfrcv1FOqNlaUV2UzoLNjl?zfOJ6zEFYB																				
PLATES (table is in inches) <table border="1"><thead><tr><th>JT</th><th>TYPE</th><th>PLATES</th><th>W</th><th>LEN</th><th>Y</th><th>X</th></tr></thead><tbody><tr><td>W</td><td>BMV1+p</td><td>MT20</td><td>3.0</td><td>4.0</td><td></td><td></td></tr></tbody></table> Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD. NOTES: (1) 1) Lateral braces to be a minimum of 2x4 SPF #2							JT	TYPE	PLATES	W	LEN	Y	X	W	BMV1+p	MT20	3.0	4.0		
JT	TYPE	PLATES	W	LEN	Y	X														
W	BMV1+p	MT20	3.0	4.0																
																				
Structural component only DWG# T-2115248 <i>me</i>																				

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410918	T32	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MITek Industries, Inc. Fri Jun 4 09:44:48 2021 Page 1
ID:GzzEEXDtfkQt_BH_M?wmsz?k45-mt41AnzMGHpOS_rrr6JXZkLGRGoX96C?3sTTdnz9j4;

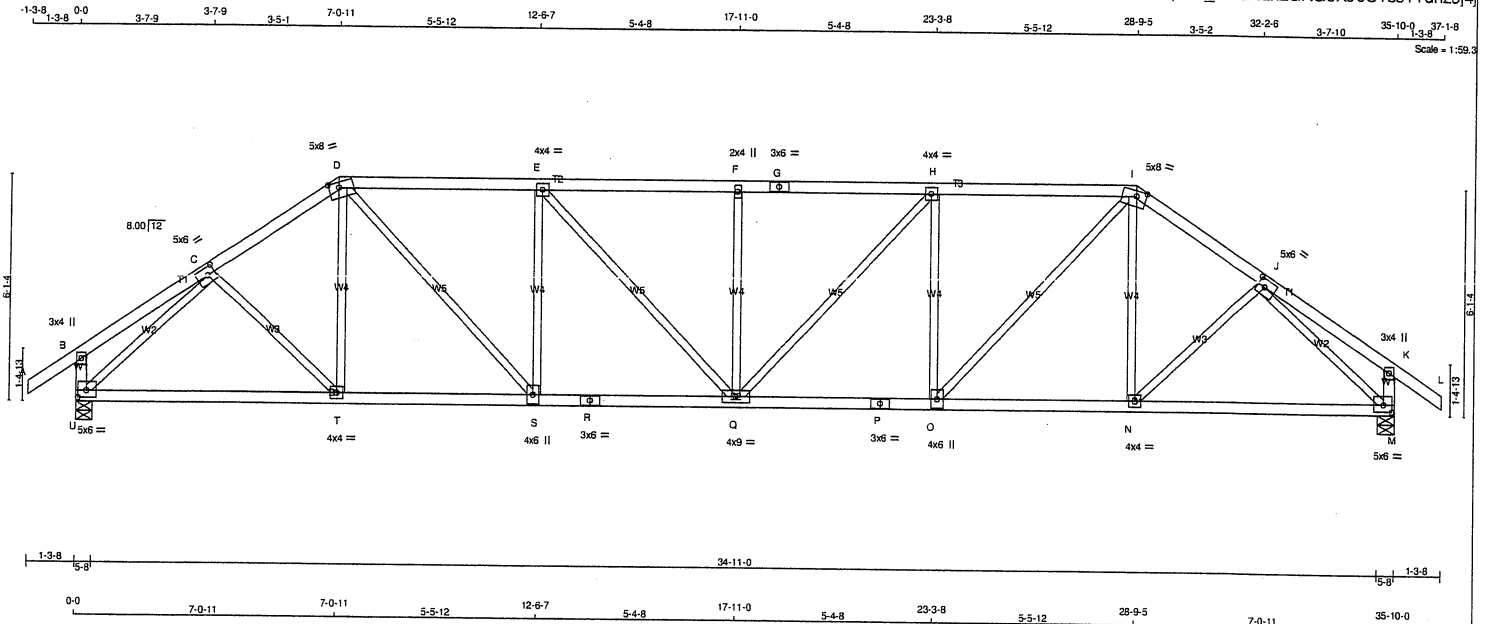

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
U - B	2x4	DRY	No.2
M - K	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - P	2x4	DRY	No.2
P - M	2x4	DRY	No.2

ALL WEBS	2x3	DRY	No.2
EXCEPT			SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
C	TMWW-t	MT20	5.0	6.0 2.50 2.50
D	TTWW-m	MT20	5.0	8.0 1.75 3.25
E	TMWW-t	MT20	4.0	4.0
F	TMW+w	MT20	2.0	4.0
G	TS-t	MT20	3.0	6.0
H	TMWW-t	MT20	4.0	4.0
I	TTWW-m	MT20	5.0	8.0 1.75 3.25
J	TMWW-t	MT20	5.0	6.0 2.50 2.50
K	TMV+p	MT20	3.0	4.0
M	BMVW1-t	MT20	5.0	6.0 2.25 2.75
N	BMWW-t	MT20	4.0	4.0
O	BMWW-t	MT20	4.0	6.0
P	BS-t	MT20	3.0	6.0
Q	BMWW-t	MT20	4.0	9.0
R	BS-t	MT20	3.0	6.0
S	BMWW-t	MT20	4.0	6.0
T	BMWW-t	MT20	4.0	4.0
U	BMVW1-t	MT20	5.0	6.0 2.25 2.75

NOTES: (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT		REQD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BRG	IN-SX
U	2101	0	2101	0	0	5-8	5-8		
M	2101	0	2101	0	0	5-8	5-8		

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
U	1484	987 / 0	0 / 0	0 / 0	0 / 0	497 / 0	0 / 0		
M	1484	987 / 0	0 / 0	0 / 0	0 / 0	497 / 0	0 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.42 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8 -91.8 0.12 (1)	10.00	C-T	0 / 144	0.03 (4)	
B-C	0 / 18	-91.8 -91.8 0.16 (1)	10.00	T-D	0 / 89	0.03 (4)	
C-D	-2359 / 0	-91.8 -91.8 0.23 (1)	4.27	D-S	0 / 1276	0.29 (1)	
D-E	-2822 / 0	-91.8 -91.8 0.59 (1)	3.59	S-E	-839 / 0	0.49 (1)	
E-F	-3079 / 0	-91.8 -91.8 0.61 (1)	3.42	E-Q	0 / 379	0.09 (1)	
F-G	-3079 / 0	-91.8 -91.8 0.61 (1)	3.42	Q-F	-454 / 0	0.27 (1)	
G-H	-3079 / 0	-91.8 -91.8 0.61 (1)	3.42	Q-H	0 / 379	0.09 (1)	
H-I	-2822 / 0	-91.8 -91.8 0.59 (1)	3.59	O-H	-839 / 0	0.49 (1)	
I-J	-2359 / 0	-91.8 -91.8 0.23 (1)	4.27	O-I	0 / 1276	0.29 (1)	
J-K	0 / 18	-91.8 -91.8 0.16 (1)	10.00	N-I	0 / 89	0.03 (4)	
K-L	0 / 35	-91.8 -91.8 0.12 (1)	10.00	N-J	0 / 144	0.03 (4)	
U-B	-255 / 0	0.0 0.0 0.03 (1)	7.81	U-C	-2567 / 0	0.99 (1)	
M-K	-255 / 0	0.0 0.0 0.03 (1)	7.81	J-M	-2567 / 0	0.99 (1)	
U-T	0 / 1840	-18.5 -18.5 0.41 (1)	10.00				
T-S	0 / 1945	-18.5 -18.5 0.42 (1)	10.00				
S-R	0 / 2822	-18.5 -18.5 0.50 (1)	10.00				
R-Q	0 / 2822	-18.5 -18.5 0.50 (1)	10.00				
Q-P	0 / 2822	-18.5 -18.5 0.50 (1)	10.00				
P-O	0 / 2822	-18.5 -18.5 0.50 (1)	10.00				
O-N	0 / 1945	-18.5 -18.5 0.42 (1)	10.00				
N-M	0 / 1840	-18.5 -18.5 0.41 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.19")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.17")
ALLOWABLE DEFL.(TL)= L/360 (1.19")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.31")

CSI: TC=0.61/1.00 (E-F:1), BC=0.50/1.00 (O-Q:1),
WB=0.99/1.00 (J-M:1), SSI=0.24/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.84 (U) (INPUT = 0.90)
JSI METAL= 0.86 (R) (INPUT = 1.00)



Structural component only
DWG# T-2117656

JOB NAME 410918	TRUSS NAME T32S	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri Jun 4 09:44:49 2021 Page 1
ID:GzzEEXDtKQt_BH_M?wmsz?k45-E4ePN7_1axF48Q2Ppqm5ytPvg6uuZT9IWC09Dz9j4i

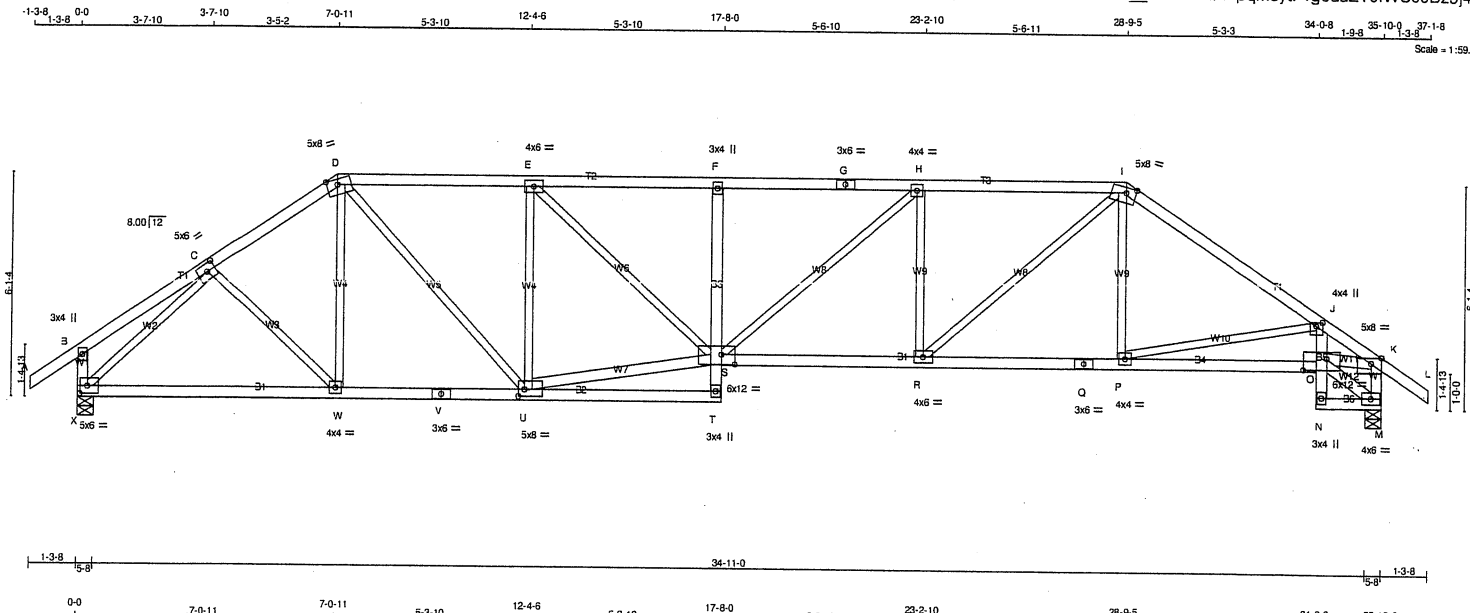

TOTAL WEIGHT = 160 lb [M]

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4 DRY	No.2	SPF
D - G	2x4 DRY	No.2	SPF
G - I	2x4 DRY	No.2	SPF
I - L	2x4 DRY	No.2	SPF
X - B	2x4 DRY	No.2	SPF
M - K	2x4 DRY	No.2	SPF
X - V	2x4 DRY	No.2	SPF
V - T	2x4 DRY	No.2	SPF
T - F	2x4 DRY	No.2	SPF
S - Q	2x4 DRY	No.2	SPF
Q - O	2x4 DRY	No.2	SPF
N - J	2x4 DRY	No.2	SPF
N - M	2x4 DRY	No.2	SPF
ALL WEBS EXCEPT	2x3 DRY	No.2	SPF
U - S	2x4 DRY	No.2	SPF
O - M	2x4 DRY	No.2	SPF
O - K	2x4 DRY	No.2	SPF

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
X	2099	0	2099	0	5-8
M	2104	0	2104	0	5-8

UNFACTORED REACTIONS		1ST LCASE	MAX./MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM.LIVE		
X	1482	986 / 0	0 / 0	0 / 0	496 / 0	0 / 0
M	1485	988 / 0	0 / 0	0 / 0	497 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) X, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.02 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO	FROM TO	FR-TO	FROM TO
A-B	0 / 35	C-W	0 / 144
B-C	0 / 18	D-U	0 / 84
C-D	-2355 / 0	E-F	0 / 1259
D-E	-2785 / 0	F-G	-1360 / 0
E-F	-3682 / 0	G-H	0 / 2763
F-G	-3700 / 0	H-I	0 / 1204
G-H	-3700 / 0	I-J	0 / 363
H-I	-3425 / 0	J-K	-821 / 0
I-J	-2817 / 0	K-L	0 / 1434
J-K	-3519 / 0	L-M	0 / 197
K-L	0 / 35	M-K	-770 / 0
X-B	-255 / 0	O-M	-2563 / 0
M-K	-2007 / 0	O-K	-143 / 0
X-W	0 / 1837		0 / 2952
V-V	0 / 1942		
V-U	0 / 1942		
U-T	0 / 88		
T-S	0 / 46		
S-F	-452 / 0		
S-R	0 / 3425		
R-Q	0 / 2331		
Q-P	0 / 2331		
P-O	0 / 3081		
N-O	0 / 17		
O-J	0 / 166		
N-M	0 / 117		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.22")
ALLOWABLE DEFL.(TL) = L/360 (1.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.42")

CSI: TC=0.76/1.00 (F-H:1), BC=0.62/1.00 (R-S:1), WB=0.99/1.00 (C-X:1), SI=0.24/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (X) (INPUT = 0.90)
JSI METAL= 0.68 (Q) (INPUT = 1.00)



Structural component only
DWG# T-2117657

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410918	T32S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington


Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri Jun 4 09:44:49 2021 Page 2
ID:GzzEEXDtikQt BH M?wImSz?k45-E4ePN7 1axF48Q2Ppqrn5ytPvg6uuZT9IWC09Dz94i

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
V	BS-t	MT20	3.0	6.0		
W	BMWW-t	MT20	4.0	4.0		
X	BMVW1-t	MT20	5.0	6.0	2.50	2.50

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES: (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

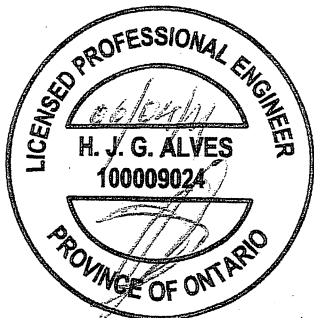


Structural component only
DWG# T-2117657 *an*

JOB NAME 410919	TRUSS NAME T32S1	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
---------------------------	----------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 15:16:03 2021 Page 1
ID:GzzEEXDtikQL_BH_M?wlmssz?k45-?KluzWveAD?WSIUdp5Lcln1kWuK84onuDdOxrYzEFYA

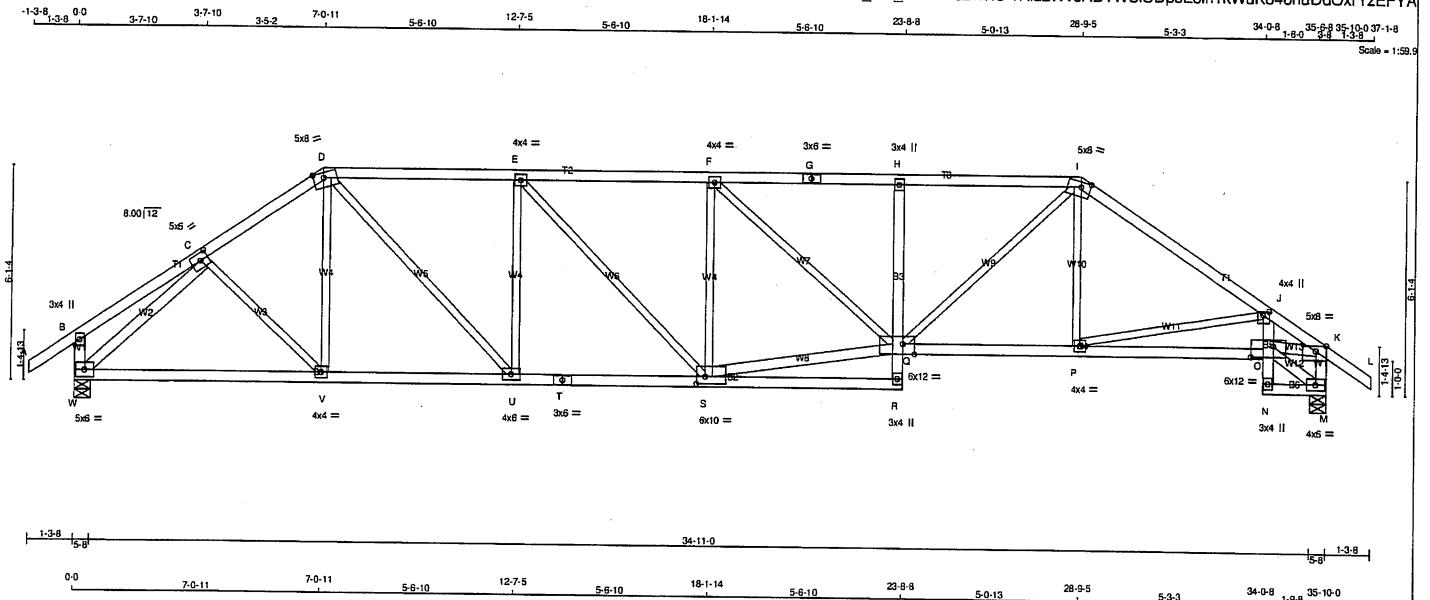

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. TOTAL WEIGHT = 163 lb

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - G	2x4	DRY No.2	SPF
G - I	2x4	DRY No.2	SPF
I - L	2x4	DRY No.2	SPF
W - B	2x4	DRY No.2	SPF
M - K	2x4	DRY No.2	SPF
W - T	2x4	DRY No.2	SPF
T - R	2x4	DRY No.2	SPF
R - H	2x4	DRY No.2	SPF
O - O	2x4	DRY No.2	SPF
N - J	2x4	DRY No.2	SPF
N - M	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF
S - Q	2x4	DRY No.2	SPF
W - C	2x4	DRY No.2	SPF
O - K	2x4	DRY No.2	SPF
O - M	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT		REQ'D	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	BRG	IN-SX	BRG	IN-SX
W	2099	0	2099	0	0	5-8	5-8		
M	2104	0	2104	0	0	5-8	5-8		

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
W	1482	986 / 0	0 / 0	0 / 0	0 / 0	496 / 0	0 / 0		
M	1485	988 / 0	0 / 0	0 / 0	0 / 0	497 / 0	0 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) W, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.33 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	MAX. C/L (LC)	MEMB.	MAX. FORCE (LBS)	MAX. C/L (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	C-V	0 / 142	0.03 (4)
B-C	0 / 19	-91.8	-91.8 0.16 (1)	10.00	V-D	0 / 91	0.03 (4)
C-D	-2357 / 0	-91.8	-91.8 0.24 (1)	4.26	D-U	0 / 1275	0.29 (1)
D-E	-2824 / 0	-91.8	-91.8 0.61 (1)	3.56	E-U	-837 / 0	0.49 (1)
E-F	-3076 / 0	-91.8	-91.8 0.64 (1)	3.40	U-S	0 / 366	0.08 (1)
F-G	-3333 / 0	-91.8	-91.8 0.60 (1)	3.34	S-F	-699 / 0	0.41 (1)
G-H	-3333 / 0	-91.8	-91.8 0.60 (1)	3.34	S-Q	0 / 3051	0.49 (1)
H-I	-3350 / 0	-91.8	-91.8 0.59 (1)	3.33	F-Q	0 / 333	0.08 (1)
I-J	-2818 / 0	-91.8	-91.8 0.61 (1)	3.64	Q-I	0 / 1384	0.31 (1)
J-K	-3519 / 0	-91.8	-91.8 0.36 (1)	3.41	P-I	0 / 202	0.05 (4)
K-L	0 / 35	-91.8	-91.8 0.12 (1)	10.00	P-J	-769 / 0	0.42 (1)
W-B	-254 / 0	0.0	0.0 0.03 (1)	7.81	W-C	-2567 / 0	0.71 (1)
M-K	-2007 / 0	0.0	0.0 0.21 (1)	5.96	O-K	0 / 2952	0.47 (1)
					O-M	-143 / 0	0.02 (1)
W-V	0 / 1839	-18.5	-18.5 0.41 (1)	10.00			
V-U	0 / 1943	-18.5	-18.5 0.43 (1)	10.00			
U-T	0 / 2825	-18.5	-18.5 0.52 (1)	10.00			
T-S	0 / 2825	-18.5	-18.5 0.52 (1)	10.00			
S-R	0 / 83	-18.5	-18.5 0.14 (4)	10.00			
R-Q	0 / 45	0.0	0.0 0.12 (1)	10.00			
Q-H	-534 / 0	0.0	0.0 0.19 (1)	7.81			
Q-P	0 / 2332	-18.5	-18.5 0.46 (1)	10.00			
P-O	0 / 3081	-18.5	-18.5 0.58 (1)	10.00			
N-O	0 / 17	0.0	0.0 0.19 (1)	10.00			
O-J	0 / 166	0.0	0.0 0.21 (1)	10.00			
N-M	0 / 117	-18.5	-18.5 0.03 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.18")
ALLOWABLE DEFL.(TL) = L/360 (1.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.36")

CSI: TC=0.84/1.00 (E-F:1), BC=0.58/1.00 (O-P:1), WB=0.71/1.00 (C-W:1), SI=0.24/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (W) (INPUT = 0.90)
JSI METAL = 0.85 (T) (INPUT = 1.00)

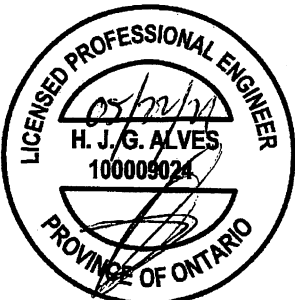

Structural component only
DWG# T-2115249

CONTINUED ON PAGE 2

JOB NAME 410919	TRUSS NAME T32S1	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES TRUSS DESC.	DRWG NO.
---------------------------	----------------------------	----------------------	-----------------	---	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 15:16:03 2021 Page 2
ID:GzzEEEXDtkQt BH M?wImSz?k45-?KluzWVeAD?WSIUdp5Lcln1kWuK84onuDdOxrYzEFYA

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
V	BMWV-t	MT20	4.0	4.0		
W	BMWV1-t	MT20	5.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2




Structural component only
DWG# T-2115249 *W*

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410918	T33	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri Jun 4 09:44:50 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wmsz?k45-iGCnbT?dou36il?EzWL?e9QaM4THd7gIXAyahfz9j4h

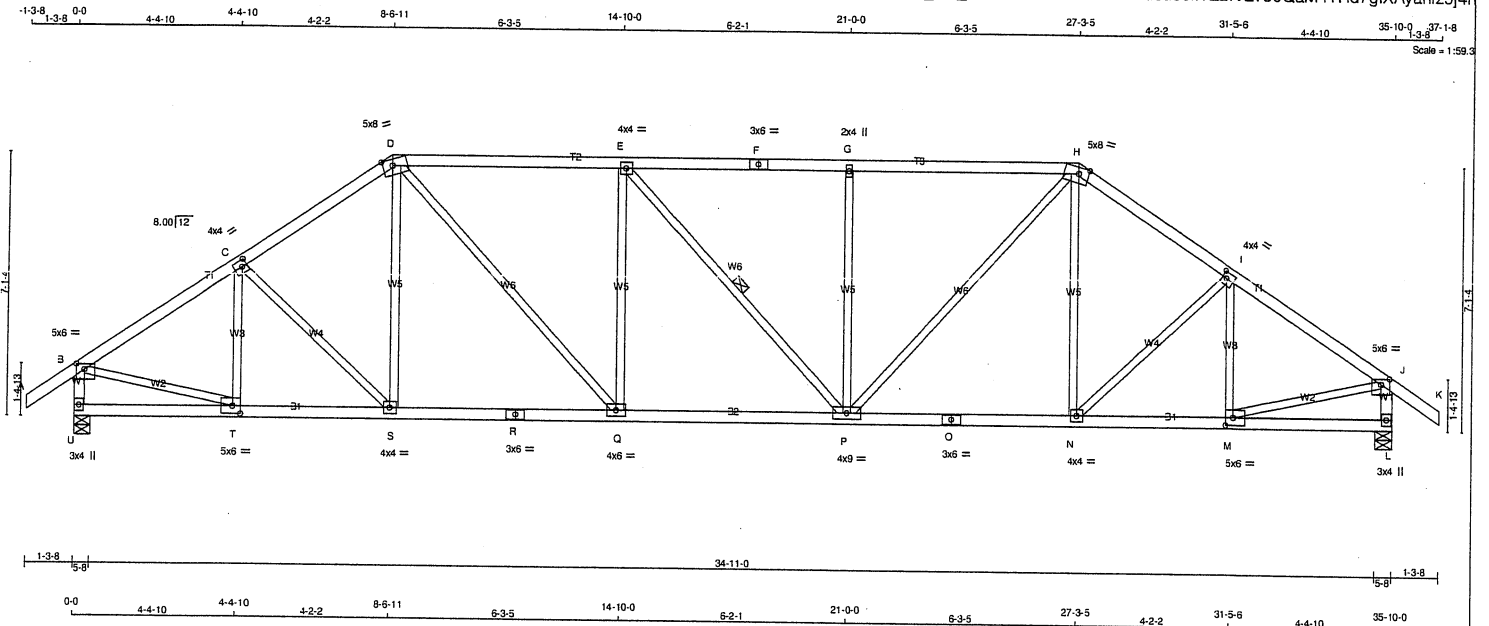

TOTAL WEIGHT = 156 lb [M]

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N. L. G. A. RULES				
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - K	2x4	DRY	No.2	SPF
U - B	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
U - R	2x4	DRY	No.2	SPF
R - O	2x4	DRY	No.2	SPF
O - L	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REQ'D
JT	VERT	DOWN	BRG	BRG
U	2101	0	0	5-8
L	2101	0	0	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
U	1484	987 / 0	0 / 0	0 / 0	0 / 0	497 / 0
L	1484	987 / 0	0 / 0	0 / 0	0 / 0	497 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.59 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO					FR-TO			
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	T-C	-407 / 0	0.11 (1)
B-C	-2318 / 0	-91.8	-91.8	0.37 (1)	4.15	C-S	-70 / 0	0.04 (1)
C-D	-2310 / 0	-91.8	-91.8	0.37 (1)	4.16	S-D	0 / 152	0.04 (4)
D-E	-2578 / 0	-91.8	-91.8	0.71 (1)	3.59	D-Q	0 / 1000	0.23 (1)
E-F	-2577 / 0	-91.8	-91.8	0.70 (1)	3.59	Q-E	-619 / 0	0.54 (1)
F-G	-2577 / 0	-91.8	-91.8	0.70 (1)	3.59	E-P	-2 / 0	0.00 (1)
G-H	-2577 / 0	-91.8	-91.8	0.70 (1)	3.60	P-G	-619 / 0	0.54 (1)
H-I	-2310 / 0	-91.8	-91.8	0.37 (1)	4.16	P-H	0 / 998	0.22 (1)
I-J	-2318 / 0	-91.8	-91.8	0.37 (1)	4.15	H-N	0 / 154	0.04 (4)
J-K	0 / 35	-91.8	-91.8	0.12 (1)	10.00	N-I	-69 / 0	0.04 (1)
U-B	-2063 / 0	0.0	0.0	0.21 (1)	5.89	M-I	-407 / 0	0.11 (1)
L-J	-2063 / 0	0.0	0.0	0.21 (1)	5.89	B-T	0 / 2007	0.45 (1)
					M-J	0 / 2007	0.45 (1)	
U-T	0 / 0	-18.5	-18.5	0.08 (4)	10.00			
T-S	0 / 1949	-18.5	-18.5	0.38 (1)	10.00			
S-R	0 / 1900	-18.5	-18.5	0.38 (1)	10.00			
R-Q	0 / 1900	-18.5	-18.5	0.38 (1)	10.00			
Q-P	0 / 2579	-18.5	-18.5	0.49 (1)	10.00			
P-O	0 / 1901	-18.5	-18.5	0.37 (1)	10.00			
O-N	0 / 1901	-18.5	-18.5	0.37 (1)	10.00			
N-M	0 / 1949	-18.5	-18.5	0.38 (1)	10.00			
M-L	0 / 0	-18.5	-18.5	0.08 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.13")
ALLOWABLE DEFL.(TL)= L/360 (1.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.25")

CSI: TC=0.71/1.00 (D-E:1), BC=0.49/1.00 (P-Q:1), WB=0.54/1.00 (E-Q:1), SS=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (B) (INPUT = 0.90)
JSI METAL= 0.63 (O) (INPUT = 1.00)




Structural component only
DWG# T-2117658

JOB NAME 410918	TRUSS NAME T33S	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
---------------------------	---------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri Jun 4 09:44:51 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wmsz?k45-AsiAoo0FZCBzJsaQXEsEAnZpZTtoxMbJSiph7E6z9j4g

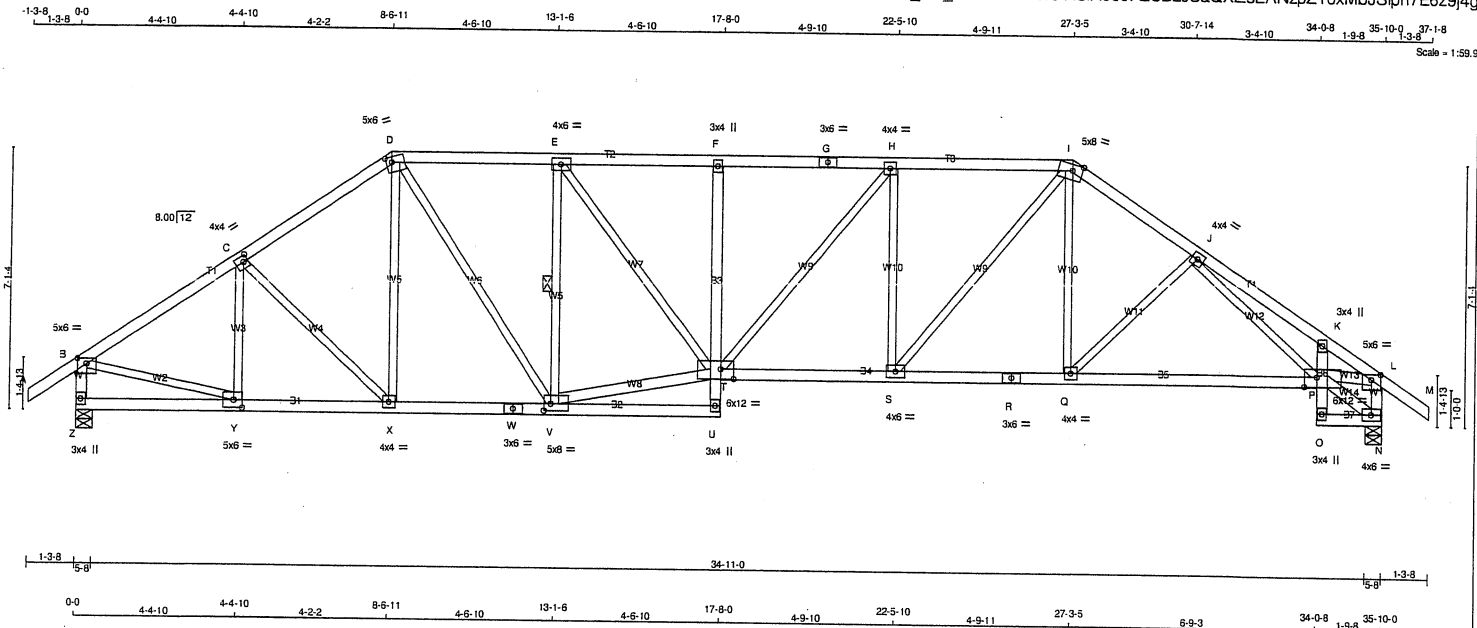

TOTAL WEIGHT = 171 lb [M]

LUMBER				DESCR.
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	
A - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
I - M	2x4	DRY	No.2	SPF
Z - B	2x4	DRY	No.2	SPF
N - L	2x4	DRY	No.2	SPF
Z - W	2x4	DRY	No.2	SPF
W - U	2x4	DRY	No.2	SPF
U - F	2x4	DRY	No.2	SPF
T - R	2x4	DRY	No.2	SPF
R - P	2x4	DRY	No.2	SPF
O - K	2x4	DRY	No.2	SPF
O - N	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
V - T	2x4	DRY	No.2	SPF
P - N	2x4	DRY	No.2	SPF
P - L	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	3.00
C	TMWW-t	MT20	4.0	4.0	2.00	1.50
D	TTWW-m	MT20	5.0	6.0	1.75	2.00
E	TMWW-t	MT20	4.0	4.0		
F	TMV-p	MT20	3.0	4.0		
G	TS-t	MT20	3.0	6.0		
H	TMWW-t	MT20	4.0	4.0		
I	TTWW-m	MT20	5.0	8.0	2.00	3.25
J	TMWW-t	MT20	4.0	4.0		
K	TMV-p	MT20	3.0	4.0		
L	TMVW-p	MT20	5.0	6.0	1.75	3.00
N	BMVW-t	MT20	4.0	6.0		
O	BMV-p	MT20	3.0	4.0		
P	BVMWW-I	MT20	6.0	12.0	3.25	4.00
Q	BMWW-t	MT20	4.0	4.0		
R	BS-t	MT20	3.0	6.0		
S	BMWW-t	MT20	4.0	6.0		
T	BVMWW-I	MT20	6.0	12.0	3.25	4.25
U	BMV-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT		REQD	
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
Z		2099	0	2099	0	0	5-8	5-8	
N		2104	0	2104	0	0	5-8	5-8	

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN.	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
Z	1482	986 / 0	0 / 0	0 / 0	0 / 0	0 / 0	496 / 0	0 / 0
N	1485	988 / 0	0 / 0	0 / 0	0 / 0	0 / 0	497 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Z, N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.56 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-V.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORZ. LOAD (LC1)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORZ. LOAD (LC1)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	Y-C	-400 / 0	0.11 (1)
B-C	-2316 / 0	-91.8	-91.8 0.37 (1)	4.16	C-X	-76 / 0	0.04 (1)
C-D	-2303 / 0	-91.8	-91.8 0.37 (1)	4.16	X-D	0 / 134	0.03 (4)
D-E	-2431 / 0	-91.8	-91.8 0.36 (1)	4.07	D-V	0 / 974	0.22 (1)
E-F	-3046 / 0	-91.8	-91.8 0.41 (1)	3.64	V-E	-1254 / 0	0.40 (1)
F-G	-3056 / 0	-91.8	-91.8 0.49 (1)	3.56	V-T	0 / 2442	0.39 (1)
G-H	-3056 / 0	-91.8	-91.8 0.49 (1)	3.56	E-T	0 / 998	0.22 (1)
H-I	-2689 / 0	-91.8	-91.8 0.48 (1)	3.66	T-H	0 / 260	0.06 (1)
I-J	-2688 / 0	-91.8	-91.8 0.29 (1)	3.99	S-H	-706 / 0	0.41 (1)
J-K	-3013 / 0	-91.8	-91.8 0.31 (1)	3.77	S-I	0 / 1034	0.23 (1)
K-L	-2989 / 0	-91.8	-91.8 0.21 (1)	3.86	Q-I	0 / 386	0.09 (1)
L-M	0 / 35	-91.8	-91.8 0.12 (1)	10.00	Q-J	-368 / 0	0.15 (1)
Z-B	-2062 / 0	0.0	0.0 0.21 (1)	5.89	J-P	0 / 69	0.02 (4)
N-L	-2028 / 0	0.0	0.0 0.21 (1)	5.94	B-Y	0 / 2006	0.45 (1)
					P-N	-117 / 0	0.01 (1)
					P-L	0 / 2454	0.39 (1)
Z-Y	0 / 0	-18.5	-18.5 0.07 (4)	10.00			
Y-X	0 / 1947	-18.5	-18.5 0.35 (1)	10.00			
X-W	0 / 1894	-18.5	-18.5 0.35 (1)	10.00			
W-V	0 / 1894	-18.5	-18.5 0.35 (1)	10.00			
V-U	0 / 60	-18.5	-18.5 0.09 (4)	10.00			
U-T	0 / 37	0.0	0.0 0.09 (1)	10.00			
T-F	-389 / 0	0.0	0.0 0.19 (1)	7.81			
T-S	0 / 2889	-18.5	-18.5 0.52 (1)	10.00			
S-R	0 / 2221	-18.5	-18.5 0.46 (1)	10.00			
R-Q	0 / 2221	-18.5	-18.5 0.46 (1)	10.00			
Q-P	0 / 2480	-18.5	-18.5 0.51 (1)	10.00			
O-P	0 / 17	0.0	0.0 0.14 (1)	10.00			
P-K	-154 / 0	0.0	0.0 0.14 (1)	7.81			
O-N	0 / 100	-18.5	-18.5 0.02 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.19")
CALCULATED VERT. DEFL.(LL)= L/999 (0.17")
ALLOWABLE DEFL.(TL)= L/360 (1.19")
CALCULATED VERT. DEFL.(TL)= L/999 (0.32")

CSI: TC=0.49/1.00 (F-H:1), BC=0.52/1.00 (S-T:1), WB=0.45/1.00 (B-Y:1), SS=0.21/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (L) (INPUT = 0.90)
JSI METAL= 0.66 (R) (INPUT = 1.00)

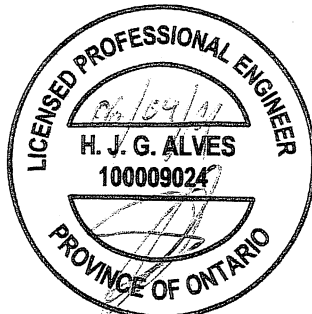

Structural component only
DWG# T-2117659

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410918	T33S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri Jun 4 09:44:51 2021 Page 2
ID:GzzEEXDtfkQt BH M?wimsz?k45-ASIAoo0FZCBzJSaQXEsEANzpZToxMbJSIph7E6z9I4g

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
V	BMWVW-t	MT20	5.0	8.0	2.25	2.25
W	BS-t	MT20	3.0	6.0		
X	BMWVW-t	MT20	4.0	4.0		
Y	BMWVW-t	MT20	5.0	6.0	2.50	2.75
Z	BMV1+p	MT20	3.0	4.0		

NOTES-

- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2




Structural component only
DWG# T-2117659

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410919	T33S1	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 15:16:04 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wlmisz?k45-TWJHBswGxX7N4v3QNptrq?axuliWpHZ2SH8UN_zEFY9

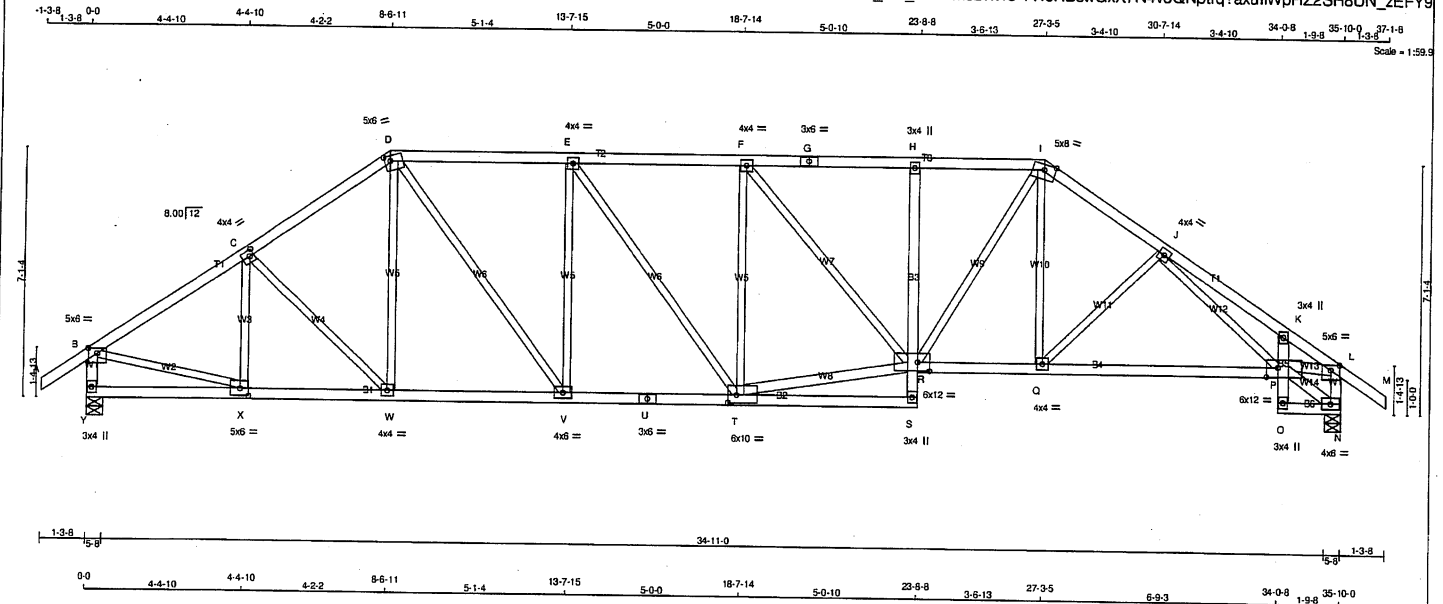

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES				BEARINGS				SPECIFIED LOADS:			
CHORDS	SIZE	LUMBER	DESCR.	FACTORED	MAXIMUM FACTORED	INPUT	REQ'D	TOP CH.	LL = 25.6	PSF	
A - D	2x4	DRY	No.2	SPF	GROSS REACTION	GROSS REACTION	BRG	DL = 6.0	PSF		
D - G	2x4	DRY	No.2	SPF	VERT	DOWN	UPLIFT	IN-SX	LL = 0.0	PSF	
G - I	2x4	DRY	No.2	SPF	Y	2099	0	5-8	DL = 7.4	PSF	
I - M	2x4	DRY	No.2	SPF	N	2104	0	5-8	TOTAL LOAD = 39.0	PSF	
M - P	2x4	DRY	No.2	SPF	UNFACTORED REACTIONS						
P - R	2x4	DRY	No.2	SPF	1ST CASE	MAX./MIN. COMPONENT REACTIONS		SPACING = 24.0 IN./C			
R - S	2x4	DRY	No.2	SPF	JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
S - H	2x4	DRY	No.2	SPF	Y	1482	986 / 0	0 / 0	0 / 0	496 / 0	0 / 0
H - P	2x4	DRY	No.2	SPF	N	1485	988 / 0	0 / 0	0 / 0	497 / 0	0 / 0
P - N	2x4	DRY	No.2	SPF	BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Y, N						
O - N	2x4	DRY	No.2	SPF	BRACING						
ALL WEBS	2x3	DRY	No.2	SPF	TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.77 FT.						
EXCEPT					MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.						
T - R	2x4	DRY	No.2	SPF	ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.						
P - N	2x4	DRY	No.2	SPF	LOADING						
P - L	2x4	DRY	No.2	SPF	TOTAL LOAD CASES: (4)						

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	3.00
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TTWW-m	MT20	5.0	6.0	1.75	2.00
E, F, J						
E	TMVW-t	MT20	4.0	4.0		
G	TS-t	MT20	3.0	6.0		
H	TMV-p	MT20	3.0	4.0		
I	TTWW-m	MT20	5.0	8.0	Edge	
K	TMV-p	MT20	3.0	4.0		
L	TMVW-p	MT20	5.0	6.0	1.75	3.00
N	BMVW-t	MT20	4.0	6.0		
O	BMV-p	MT20	3.0	4.0		
P	BMVWVW-t	MT20	6.0	12.0	3.25	4.00
Q	BMVW-t	MT20	4.0	4.0		
R	BMVWVW-t	MT20	6.0	12.0	3.00	4.00
S	BMV-p	MT20	3.0	4.0		
T	BMVWVW-t	MT20	6.0	10.0	2.75	3.00
U	BS-t	MT20	3.0	6.0		
V	BMVW-t	MT20	4.0	6.0		
W	BMVW-t	MT20	4.0	4.0		

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FORCE (LBS)	VERT. LOAD	MEMB.	MAX. FACTORED	FORCE (LBS)	MAX
FR-TO	FROM	TO	CS (LC)	FR-TO	FROM	TO	CS (LC)
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	X-C	-402 / 0	0.11 (1)
B-C	-2316 / 0	-91.8	-91.8 0.37 (1)	4.16	C-W	-73 / 0	0.04 (1)
C-D	-2305 / 0	-91.8	-91.8 0.37 (1)	4.16	W-D	0 / 143	0.04 (4)
D-E	-2484 / 0	-91.8	-91.8 0.46 (1)	3.92	T-F	-596 / 0	0.52 (1)
E-F	-2616 / 0	-91.8	-91.8 0.47 (1)	3.83	T-R	0 / 2619	0.42 (1)
F-G	-2749 / 0	-91.8	-91.8 0.38 (1)	3.86	F-R	0 / 197	0.04 (1)
G-H	-2749 / 0	-91.8	-91.8 0.38 (1)	3.86	R-I	0 / 995	0.22 (1)
H-I	-2758 / 0	-91.8	-91.8 0.32 (1)	3.89	Q-I	0 / 385	0.09 (1)
I-J	-2688 / 0	-91.8	-91.8 0.29 (1)	3.99	Q-J	-368 / 0	0.15 (1)
J-K	-3013 / 0	-91.8	-91.8 0.31 (1)	3.77	J-P	0 / 69	0.02 (4)
K-L	-2989 / 0	-91.8	-91.8 0.21 (1)	3.86	B-X	0 / 2005	0.45 (1)
L-M	0 / 35	-91.8	-91.8 0.12 (1)	10.00	P-N	-117 / 0	0.01 (1)
Y-B	-2061 / 0	0.0	0.0 0.21 (1)	5.89	P-L	0 / 2454	0.39 (1)
N-L	-2028 / 0	0.0	0.0 0.21 (1)	5.94	E-T	0 / 224	0.05 (1)
Y-X	0 / 0	-18.5	-18.5 0.07 (4)	10.00	D-V	0 / 981	0.22 (1)
X-W	0 / 1947	-18.5	-18.5 0.36 (1)	10.00	V-E	-697 / 0	0.61 (1)
W-V	0 / 1895	-18.5	-18.5 0.35 (1)	10.00			
V-U	0 / 2484	-18.5	-18.5 0.45 (1)	10.00			
U-T	0 / 2484	-18.5	-18.5 0.45 (1)	10.00			
T-S	0 / 54	-18.5	-18.5 0.11 (4)	10.00			
S-R	0 / 41	0.0	0.0 0.08 (1)	10.00			
R-H	-422 / 0	0.0	0.0 0.20 (1)	7.81			
R-Q	0 / 2222	-18.5	-18.5 0.46 (1)	10.00			
Q-P	0 / 2480	-18.5	-18.5 0.51 (1)	10.00			
O-P	0 / 17	0.0	0.0 0.14 (1)	10.00			
P-K	-154 / 0	0.0	0.0 0.14 (1)	7.81			
O-N	0 / 100	-18.5	-18.5 0.02 (1)	10.00			

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.
(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD
ALLOWABLE DEFL.(LL) = L/360 (1.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.28")
CSI: TC=0.47/1.00 (E-F:1), BC=0.51/1.00 (P-Q:1),
WB=0.61/1.00 (E-V:1), SS=0.22/1.00 (D-E:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10
COMPANION LIVE LOAD FACTOR = 1.00
AUTOSOLVE LEFT HEEL ONLY
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873
PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.90 (L) (INPUT = 0.90)
JSI METAL= 0.75 (U) (INPUT = 1.00)



Structural component only
DWG# T-2115250

JOB NAME 410919	TRUSS NAME T33S1	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 15:16:04 2021 Page 2
ID:GzzEEXDtkQt BH M?wimsz?k45-TWJHBswGxX7N4v3QNptq?axulIWpHZ2SH8UN zEFY9

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
X	BMWV-t	MT20	5.0	6.0	2.50	2.75
Y	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

NOTES- (1)

- 1) Lateral braces to be a minimum of 2x4 SPF #2




Structural component only
DWG# T-2115250 42

JOB NAME 410918	TRUSS NAME T34	QUANTITY 2	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri Jun 4 09:44:52 2021 Page 1
ID:GzzEEXDtKQt_BH_M?wmsz?k45-efJY?80tKVJqxc9d4xNTjaVmtAi52Sb_TRgmYz9j4f

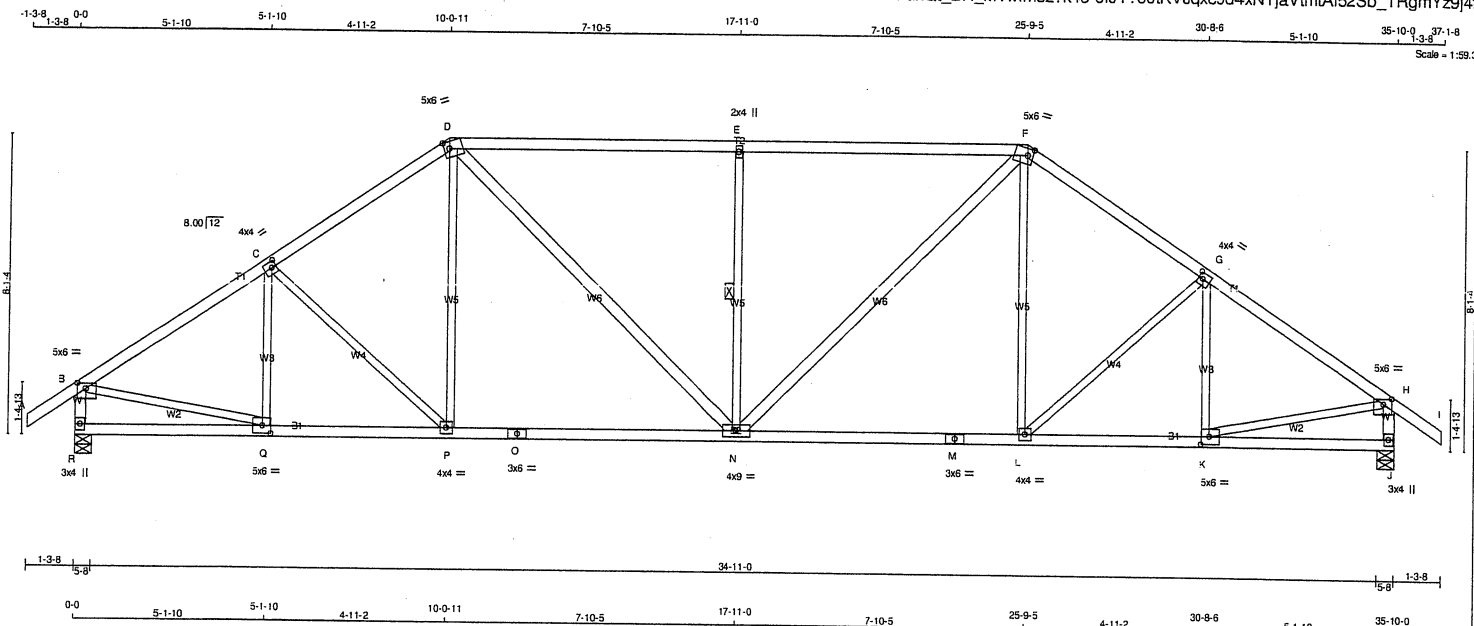

LUMBER				
N. L. G. A. RULES	SIZE	LUMBER	DESCR.	
CHORDS				
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
R - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
R - O	2x4	DRY	No.2	SPF
O - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
D - N	2x4	DRY	No.2	SPF
N - F	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	2.75
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TTWW-m	MT20	5.0	6.0	2.25	1.75
E	TMW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	6.0	2.25	1.75
G	TMVW-t	MT20	4.0	4.0	2.00	1.50
H	TMVW-p	MT20	5.0	6.0	1.75	2.75
J	BMV1+p	MT20	3.0	4.0		
K	BMVW-t	MT20	5.0	6.0	2.50	2.75
L	BMVW-t	MT20	4.0	4.0		
M	BS-t	MT20	3.0	6.0		
N	BMVW-t	MT20	4.0	9.0		
O	BS-t	MT20	3.0	6.0		
P	BMVW-t	MT20	4.0	4.0		
Q	BMVW-t	MT20	5.0	6.0	2.50	2.75
R	BMV1+p	MT20	3.0	4.0		

NOTES-

- (1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX
R	2101	0	2101	0	5-8	5-8
J	2101	0	2101	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
R	1484	987 / 0	0 / 0	0 / 0	0 / 0	497 / 0	0 / 0
J	1484	987 / 0	0 / 0	0 / 0	0 / 0	497 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.17 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8 -91.8 0.12 (1)	10.00	Q-C	-331 / 0	0.11 (1)	
B-C	-2368 / 0	-91.8 -91.8 0.39 (1)	4.12	C-P	-210 / 0	0.18 (1)	
C-D	-2243 / 0	-91.8 -91.8 0.37 (1)	4.23	P-D	0 / 264	0.06 (4)	
D-E	-2365 / 0	-91.8 -91.8 0.91 (1)	3.17	D-N	0 / 738	0.12 (1)	
E-F	-2243 / 0	-91.8 -91.8 0.91 (1)	3.17	N-E	-889 / 0	0.37 (1)	
F-G	-2243 / 0	-91.8 -91.8 0.37 (1)	4.23	N-F	0 / 738	0.12 (1)	
G-H	-2368 / 0	-91.8 -91.8 0.39 (1)	4.12	L-F	0 / 264	0.06 (4)	
H-I	0 / 35	-91.8 -91.8 0.12 (1)	10.00	L-G	-210 / 0	0.18 (1)	
R-B	-2058 / 0	0.0 0.0 0.21 (1)	5.89	K-G	-331 / 0	0.11 (1)	
J-H	-2058 / 0	0.0 0.0 0.21 (1)	5.89	B-Q	0 / 2039	0.46 (1)	
				K-H	0 / 2039	0.46 (1)	
R-Q	0 / 0	-18.5 -18.5 0.10 (4)	10.00				
Q-P	0 / 1995	-18.5 -18.5 0.41 (1)	10.00				
P-O	0 / 1842	-18.5 -18.5 0.43 (1)	10.00				
O-N	0 / 1842	-18.5 -18.5 0.43 (1)	10.00				
N-M	0 / 1842	-18.5 -18.5 0.43 (1)	10.00				
M-L	0 / 1842	-18.5 -18.5 0.43 (1)	10.00				
L-K	0 / 1995	-18.5 -18.5 0.41 (1)	10.00				
K-J	0 / 0	-18.5 -18.5 0.10 (4)	10.00				

TOTAL WEIGHT = 2 X 160 = 321 lb [M/F]

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL)= L/360 (1.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.91/1.00 (D-E:1), BC=0.43/1.00 (N-P:1), WB=0.46/1.00 (H-K:1), SS=0.35/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (H) (INPUT = 0.90)
JSI METAL= 0.58 (O) (INPUT = 1.00)

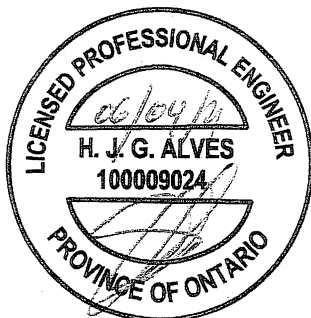

Structural component only
DWG# T-2117660

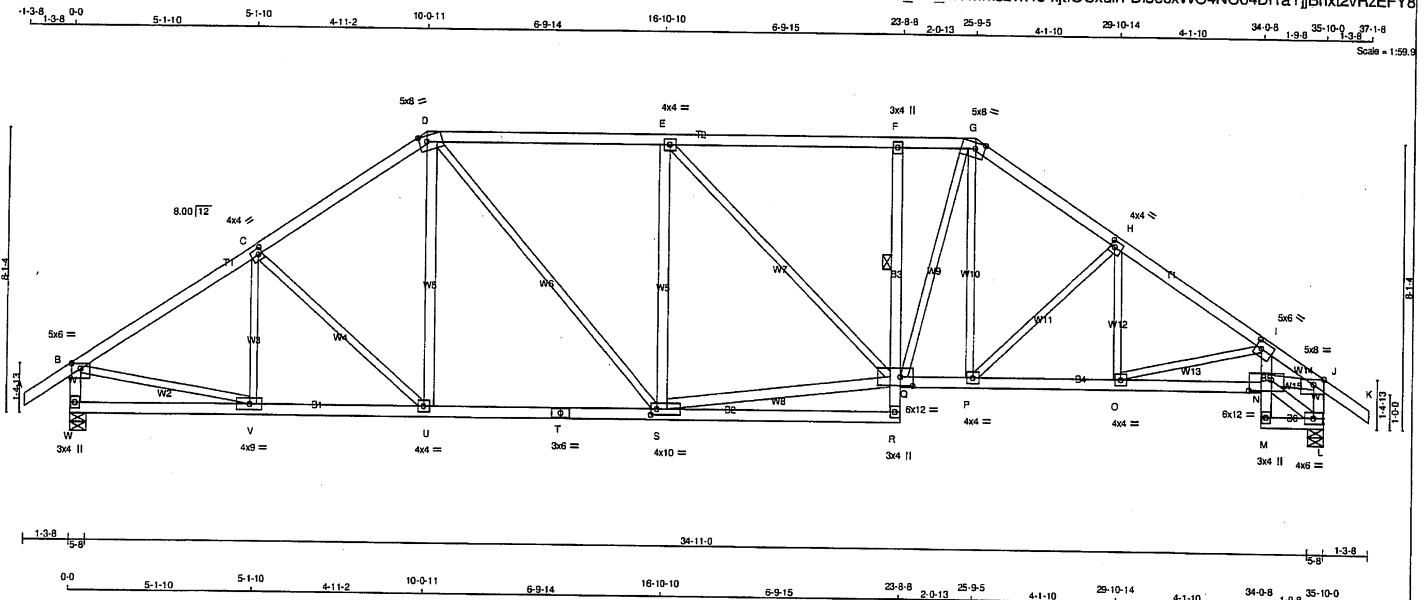

LUMBER		N. L. G. A. RULES		LUMBER	DESCR.
CHORDS	SIZE				
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
G - K	2x4	DRY	No.2	SPF	
W - B	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
T - R	2x4	DRY	No.2	SPF	
R - F	2x4	DRY	No.2	SPF	
Q - N	2x4	DRY	No.2	SPF	
M - I	2x4	DRY	No.2	SPF	
M - L	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	
U - D	2x4	DRY	No.2	SPF	
S - E	2x4	DRY	No.2	SPF	
S - Q	2x4	DRY	No.2	SPF	
N - L	2x4	DRY	No.2	SPF	
N - J	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)						
J	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	3.00
C	TMVW-t	MT20	4.0	6.0	2.00	1.50
D	TTVW-m	MT20	5.0	8.0	2.00	2.75
E	TMVW-t	MT20	4.0	4.0		
F	TMV-p	MT20	3.0	4.0		
G	TTVW-m	MT20	5.0	8.0	2.00	3.25
H	TMVW-t	MT20	4.0	4.0	2.00	1.50
I	TMVW-t	MT20	5.0	6.0	2.50	2.00
J	BMVW-1	MT20	5.0	8.0	Edge	3.50
L	TMV-p	MT20	4.0	6.0		
M	BMV-p	MT20	3.0	4.0		
N	BMVW-W-I	MT20	6.0	12.0	3.75	7.75
O, P, U						
Q	BMVW-t	MT20	4.0	4.0		
R	BMVWW-W-I	MT20	6.0	12.0	3.00	4.25
R	BMV-p	MT20	3.0	4.0		
S	BMVWW-t	MT20	4.0	10.0	2.00	2.00
T	BS-t	MT20	3.0	6.0		
V	BMVW-t	MT20	4.0	9.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
FACTORED GROSS REACTION			MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
W	2099	0	2099	0	0	5-8	5-8
L	2104	0	2104	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
W	1482	986 / 0	0 / 0	0 / 0	0 / 0	496 / 0	0 / 0
L	1485	988 / 0	0 / 0	0 / 0	0 / 0	497 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) W, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.67 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/ 2 LENGTH OF F-Q.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBBS				
MAX. FACTORED		FACTORED		MAX. FACTORED		MAX. FACTORED		
MEMB.	FORCE	VERT. LOAD	LC1	MAX.	MEMB.	FORCE	MAX	
	(LBS)	(PLF)	CSI	UNBRAC		(LBS)	CSI (LC)	
FR-TO		FROM	TO	LENGTH	FR-TO			
A-B	0 / 35	-91.8	-91.8	1.12 (f)	10.00	V-C	-324 / 0	0.11 (t)
B-C	-2366 / 0	-91.8	-91.8	0.39 (f)	4.12	C-U	-216 / 0	0.18 (t)
C-D	-2236 / 0	-91.8	-91.8	0.37 (f)	4.24	U-D	0 / 251	0.04 (t)
D-E	-2317 / 0	-91.8	-91.8	0.62 (f)	3.82	D-S	0 / 734	0.17 (t)
E-F	-2353 / 0	-91.8	-91.8	0.60 (f)	3.83	S-E	-751 / 0	0.68 (t)
F-G	-2360 / 0	-91.8	-91.8	0.27 (f)	4.22	S-Q	0 / 2298	0.37 (t)
G-H	-2542 / 0	-91.8	-91.8	0.28 (f)	4.10	E-Q	0 / 41	0.01 (t)
H-I	-2928 / 0	-91.8	-91.8	0.32 (f)	3.83	Q-G	0 / 851	0.19 (t)
I-J	-3387 / 0	-91.8	-91.8	0.21 (f)	3.67	P-G	0 / 421	0.09 (t)
J-K	0 / 35	-91.8	-91.8	0.12 (f)	10.00	P-H	-505 / 0	0.30 (t)
W-B	-2057 / 0	0.0	0.0	0.21 (f)	5.90	C-H	0 / 110	0.04 (t)
L-J	-2010 / 0	0.0	0.0	0.21 (f)	5.95	O-I	-480 / 0	0.16 (t)
						B-V	0 / 2037	0.46 (t)
W-V	0 / 0	-18.5	-18.5	0.10 (t)	10.00	N-L	-138 / 0	0.01 (t)
V-U	0 / 1993	-18.5	-18.5	0.39 (f)	10.00	N-J	0 / 2796	0.45 (t)
U-T	0 / 1837	-18.5	-18.5	0.41 (f)	10.00			
T-S	0 / 1837	-18.5	-18.5	0.41 (f)	10.00			
S-R	0 / 51	-18.5	-18.5	0.21 (t)	10.00			
R-Q	0 / 55	0.0	0.0	0.08 (f)	10.00			
Q-F	-445 / 0	0.0	0.0	0.08 (f)	6.25			
Q-P	0 / 2097	-18.5	-18.5	0.37 (f)	10.00			
P-O	0 / 2456	-18.5	-18.5	0.43 (f)	10.00			
O-N	0 / 2920	-18.5	-18.5	0.52 (f)	10.00			
M-N	0 / 17	0.0	0.0	0.18 (f)	10.00			
N-I	0 / 176	0.0	0.0	0.20 (f)	10.00			
M-L	0 / 113	-18.5	-18.5	0.03 (t)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP	CH.	LL	=	25.6	PSF
		DL	=	6.0	PSF
BOT	CH.	LL	=	0.0	PSF
		DL	=	7.4	PSF
TOTAL LOAD				=	39.0 PSF

SPACING = 24.0 IN. C/C

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.19")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.13")
ALLOWABLE DEFL.(TL)= L/360 (1.19")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.29")

CSI: TC=0.62/1.00 (D-E:1), BC=0.52/1.00 (N-O:1),
WB=0.68/1.00 (E-S:1), SSI=0.30/1.00 (D-E:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	650	371	1747	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (B) (INPUT = 0.90)
JSI METAL= 0.59 (T) (INPUT = 1.00)



Structural component only
DWG# T-2115251 *11*

CONTINUED ON PAGE 2

JOB NAME 410919	TRUSS NAME T34S1	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
W	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 15:16:05 2021 Page 2
ID:GzzEEXDtkQt BH M?wlmsz?k45-xitfOCXuifDI3ecxWO4NC64Di1aYjiBhxt2vRzEFY8

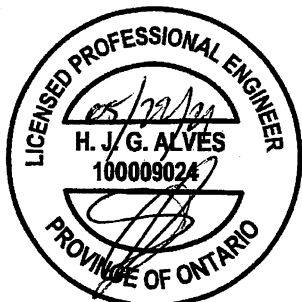


Structural component only
DWG# T-2115251 *2/2*

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410918	T35	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri Jun 4 09:44:53 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wmsz?k45-6rtwDU1V5pRhZlpefuiGo285HWNqUdkD7BEI_z9j4e

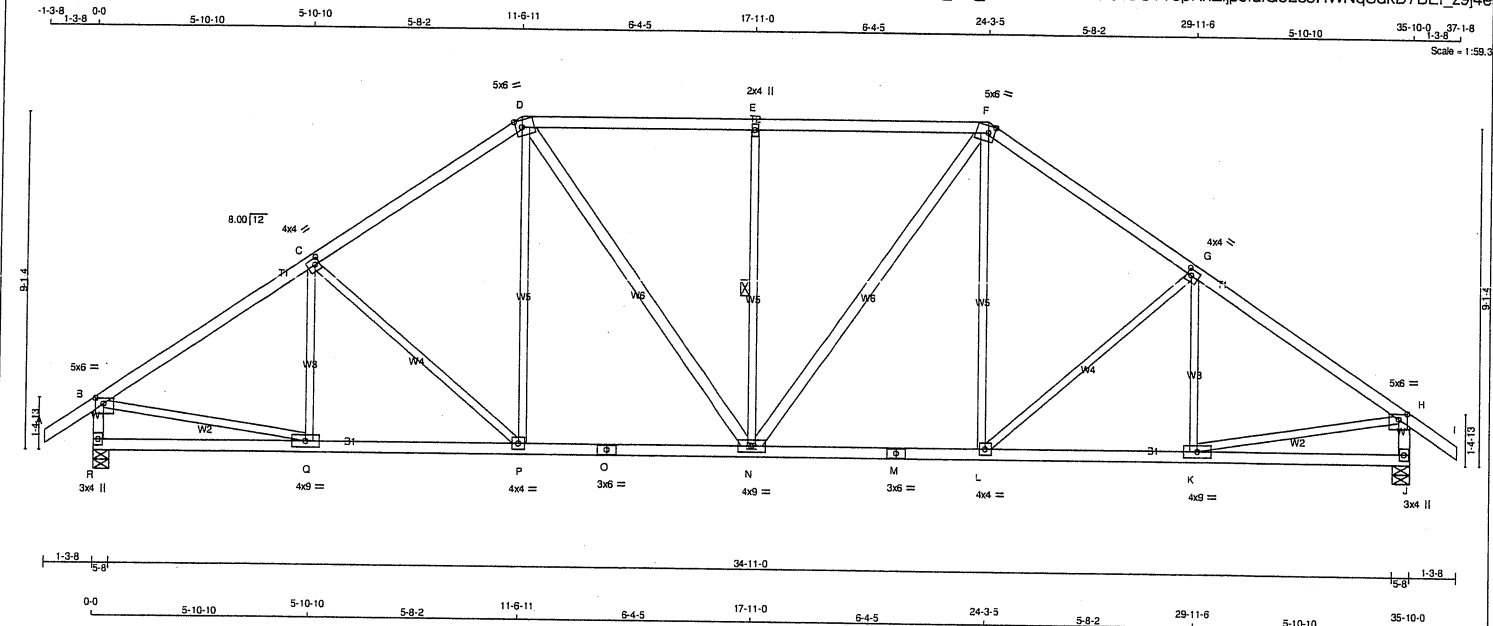

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	6.0	1.75 2.75
C	TMVW-t	MT20	4.0	4.0	2.00 1.50
D	TTWW-m	MT20	5.0	6.0	2.25 2.00
E	TMVW-w	MT20	2.0	4.0	
F	TTWW-m	MT20	5.0	6.0	2.25 2.00
G	TMVW-t	MT20	4.0	4.0	2.00 1.50
H	TMVW-p	MT20	5.0	6.0	1.75 2.75
J	BMV1+p	MT20	3.0	4.0	
K	BMVW-t	MT20	4.0	4.0	
L	BMVW-t	MT20	4.0	4.0	
M	BS-t	MT20	3.0	6.0	
N	BMVWW-t	MT20	4.0	9.0	
O	BS-t	MT20	3.0	6.0	
P	BMVW-t	MT20	4.0	4.0	
Q	BMVW-t	MT20	4.0	9.0	
R	BMV1+p	MT20	3.0	4.0	

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT REQRD BRG
JT	VERT	HORZ	DOWN	HORZ UPLIFT
R	2101	0	2101	0
J	2101	0	2101	0

UNFACTORED REACTIONS		1ST LCASE	MAX./MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
R	1484	987 / 0	0 / 0
J	1484	987 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.95 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
MEMB.	FR-TO	FROM	TO	FROM	TO	FROM	TO
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	Q-C	-257 / 8
B-C	-2398 / 0	-91.8	-91.8	0.52 (1)	3.95	C-P	-349 / 0
C-D	-2154 / 0	-91.8	-91.8	0.48 (1)	4.16	P-D	0 / 340
D-E	-2065 / 0	-91.8	-91.8	0.55 (1)	4.10	D-N	0 / 514
E-F	-2065 / 0	-91.8	-91.8	0.55 (1)	4.10	N-E	-716 / 0
F-G	-2154 / 0	-91.8	-91.8	0.48 (1)	4.16	N-F	0 / 514
G-H	-2398 / 0	-91.8	-91.8	0.52 (1)	3.95	L-F	0 / 340
H-I	0 / 35	-91.8	-91.8	0.12 (1)	10.00	L-G	-349 / 0
I-B	-2055 / 0	0.0	0.0	0.21 (1)	5.90	K-G	-257 / 8
J-H	-2055 / 0	0.0	0.0	0.21 (1)	5.90	B-Q	0 / 2058
R-Q	0 / 0	-18.5	-18.5	0.14 (4)	10.00	K-H	0 / 2058
Q-P	0 / 2024	-18.5	-18.5	0.40 (1)	10.00		
P-O	0 / 1764	-18.5	-18.5	0.36 (1)	10.00		
O-N	0 / 1764	-18.5	-18.5	0.36 (1)	10.00		
N-M	0 / 1764	-18.5	-18.5	0.36 (1)	10.00		
M-L	0 / 1764	-18.5	-18.5	0.36 (1)	10.00		
L-K	0 / 2024	-18.5	-18.5	0.40 (1)	10.00		
K-J	0 / 0	-18.5	-18.5	0.14 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC0 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC0 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.19")
CALCULATED VERT. DEFL.(LL) = U/999 (0.10")
ALLOWABLE DEFL.(TL)= L/360 (1.19")
CALCULATED VERT. DEFL.(TL) = U/999 (0.20")

CSI: TC=0.55/1.00 (D-E:1), BC=0.40/1.00 (K-L:1), WB=0.46/1.00 (H-K:1), SSI=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (H) (INPUT = 0.90)
JSI METAL= 0.57 (O) (INPUT = 1.00)



JOB NAME 410918	TRUSS NAME T36	QUANTITY 2	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.420 S Jan 21 2021 MITek Industries, Inc. Fri Jun 4 09:44:53 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wmsz?k45-6rtwDU1V5pRhZlJpefuiGo26rHW_qUbkd7BEI_z9j4e

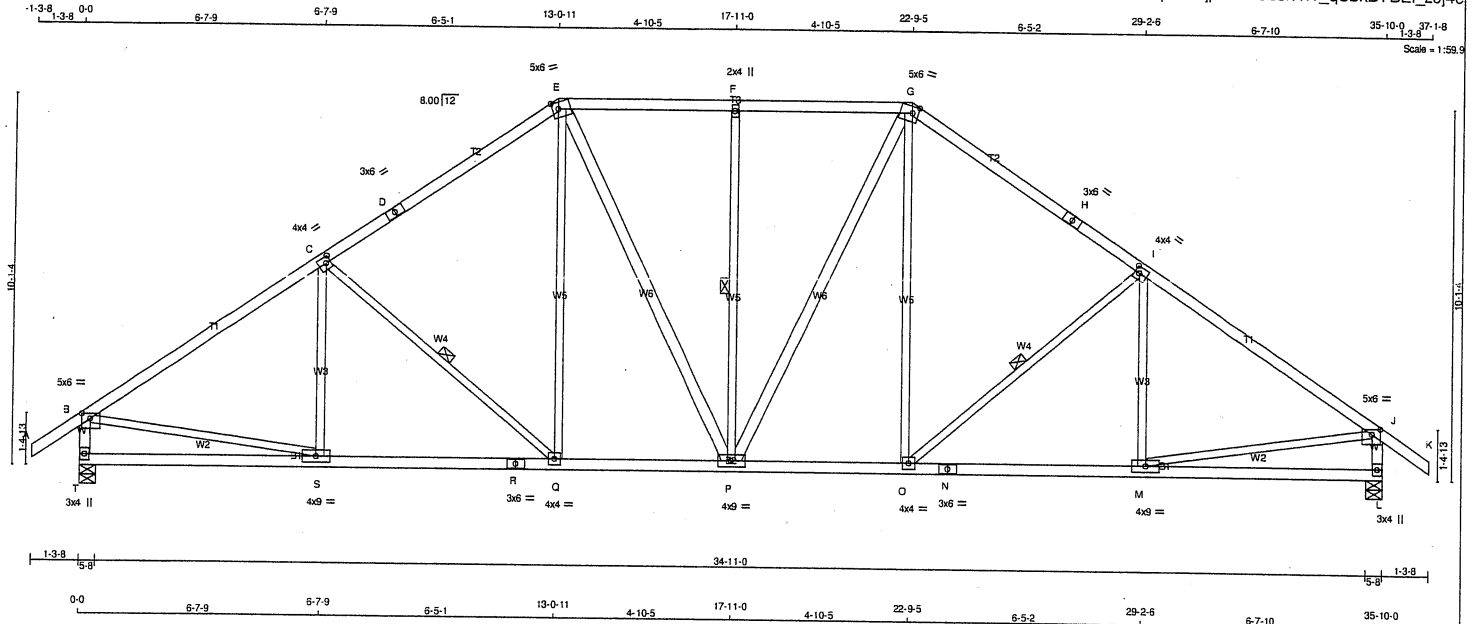

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
G - H	2x4	DRY	No.2	SPF
H - K	2x4	DRY	No.2	SPF
T - B	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
T - R	2x4	DRY	No.2	SPF
R - N	2x4	DRY	No.2	SPF
N - L	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
E - P	2x4	DRY	No.2	SPF
P - G	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	2.75
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TS-t	MT20	3.0	6.0		
E	TTWW-m	MT20	5.0	6.0	2.25	2.00
F	TMVW-w	MT20	2.0	4.0		
G	TTWW-m	MT20	5.0	6.0	2.25	2.00
H	TS-t	MT20	3.0	6.0		
I	TMVW-t	MT20	4.0	4.0	2.00	1.50
J	TMVW-p	MT20	5.0	6.0	1.75	2.75
L	BMV1+p	MT20	3.0	4.0		
M	BMVW-t	MT20	4.0	9.0		
N	BS-t	MT20	3.0	6.0		
O	BMVW-t	MT20	4.0	4.0		
P	BMVW-t	MT20	4.0	9.0		
Q	BMVW-t	MT20	4.0	4.0		
R	BS-t	MT20	3.0	6.0		
S	BMVW-t	MT20	4.0	9.0		
T	BMV1+p	MT20	3.0	4.0		

NOTES

(1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REQD
JT	VERT	HORZ	DOWN	HORZ
T	2101	0	2101	0
L	2101	0	2101	0

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
T	1484	987 / 0	0 / 0	0 / 0	497 / 0	0 / 0
L	1484	987 / 0	0 / 0	0 / 0	497 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-Q, F-P, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	S-C	-197 / 44	0.10 (1)
B-C	-2412 / 0	-91.8	-91.8 0.70 (1)	3.72	C-Q	-478 / 0	0.24 (1)
C-D	-2055 / 0	-91.8	-91.8 0.63 (1)	4.05	Q-E	0 / 414	0.09 (1)
D-E	-2055 / 0	-91.8	-91.8 0.63 (1)	4.05	E-P	0 / 345	0.06 (1)
E-F	-1832 / 0	-91.8	-91.8 0.31 (1)	4.64	P-F	-540 / 0	0.38 (1)
F-G	-1832 / 0	-91.8	-91.8 0.31 (1)	4.64	P-G	0 / 345	0.06 (1)
G-H	-2055 / 0	-91.8	-91.8 0.63 (1)	4.05	O-G	0 / 414	0.09 (1)
H-I	-2055 / 0	-91.8	-91.8 0.63 (1)	4.05	O-I	-478 / 0	0.24 (1)
I-J	-2412 / 0	-91.8	-91.8 0.70 (1)	3.72	M-I	-197 / 44	0.10 (1)
J-K	0 / 35	-91.8	-91.8 0.12 (1)	10.00	B-S	0 / 2067	0.47 (1)
T-B	-2050 / 0	0.0	0.0 0.21 (1)	5.91	M-J	0 / 2067	0.47 (1)
L-J	-2050 / 0	0.0	0.0 0.21 (1)	5.91			
T-S	0 / 0	-18.5	-18.5 0.19 (4)	10.00			
S-R	0 / 2040	-18.5	-18.5 0.42 (1)	10.00			
R-Q	0 / 2040	-18.5	-18.5 0.42 (1)	10.00			
Q-P	0 / 1678	-18.5	-18.5 0.33 (1)	10.00			
P-O	0 / 1678	-18.5	-18.5 0.33 (1)	10.00			
O-N	0 / 2040	-18.5	-18.5 0.42 (1)	10.00			
N-M	0 / 2040	-18.5	-18.5 0.42 (1)	10.00			
M-L	0 / 0	-18.5	-18.5 0.19 (4)	10.00			

TOTAL WEIGHT = 2 X 173 = 347 lb

[M/F]

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL) = L/360 (1.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.19")

CSI: TC=0.70/1.00 (I-J:1), BC=0.42/1.00 (M-O:1), WB=0.47/1.00 (J-M:1), SSI=0.24/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PS)	(PL)	(PL)
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (J) (INPUT = 0.90)
JSI METAL = 0.59 (R) (INPUT = 1.00)



Structural component only
DWG# T-2117662

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
410918	T37	1	2	ROYAL PINE HOMES	
				TRUSS DESC.	

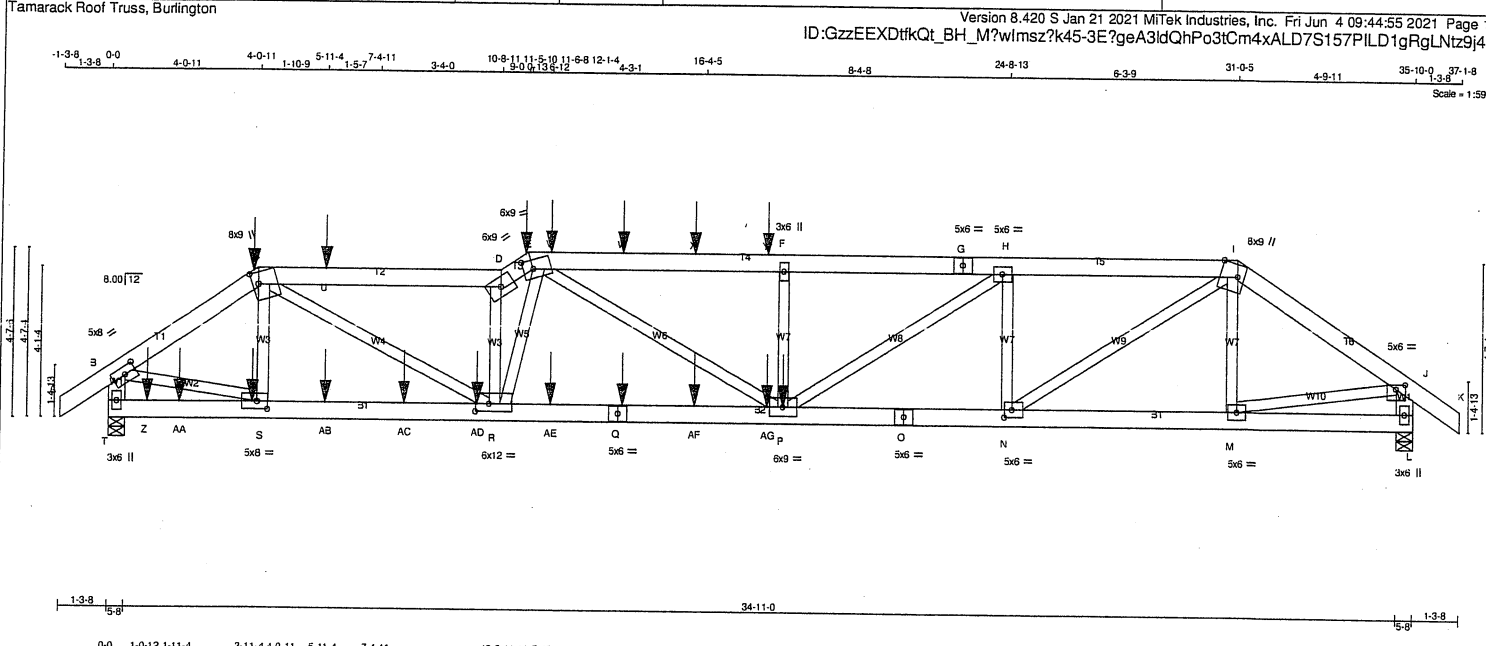

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x6	DRY	No.2	SPF	
C - D	2x6	DRY	No.2	SPF	
D - E	2x6	DRY	No.2	SPF	
E - G	2x6	DRY	No.2	SPF	
G - I	2x6	DRY	No.2	SPF	
I - K	2x6	DRY	No.2	SPF	
L - B	2x6	DRY	No.2	SPF	
L - J	2x6	DRY	No.2	SPF	
T - Q	2x6	DRY	No.2	SPF	
Q - O	2x6	DRY	No.2	SPF	
O - L	2x6	DRY	No.2	SPF	

ALL WEBS EXCEPT 2x4 DRY No.2 SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 2 12		SIDE(122.0)
C - D 2 12		SIDE(61.0)
D - E 2 12		SIDE(0.0)
E - G 2 12		SIDE(0.0)
G - I 2 12		TOP
I - K 2 12		TOP
L - B 2 12		TOP
L - J 2 12		TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
T - Q 2 12		SIDE(183.1)
Q - O 2 12		SIDE(183.1)
O - L 2 12		TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x4 1 6		SIDE(336.0)
F - P 1 6		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT		REQD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX	BRG
T	4909	0	4909	0	0	5-8	5-8		
L	3808	0	3808	0	0	5-8	5-8		

UNFACTORED REACTIONS		1ST CASE		MAX./MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
T	3457	2347 / 0	0 / 0	0 / 0	0 / 0
L	2685	1808 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.16 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING		TOTAL LOAD CASES: (4)	
CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)
FR-TO	FROM TO	LENGTH	FR-TO
A-B	0 / 36	-91.8 -91.8 0.04 (1)	10.00
B-C	-6191 / 0	-91.8 -91.8 0.12 (1)	4.69
C-U	-10492 / 0	-186.3 -186.3 0.65 (1)	3.16
U-D	-10492 / 0	-186.3 -186.3 0.65 (1)	3.16
D-E	-12809 / 0	-91.8 -91.8 0.20 (1)	3.33
E-V	-11479 / 0	-91.8 -91.8 0.58 (1)	3.18
V-W	-11479 / 0	-91.8 -91.8 0.58 (1)	3.18
W-X	-11479 / 0	-91.8 -91.8 0.58 (1)	3.18
X-Y	-11479 / 0	-91.8 -91.8 0.58 (1)	3.18
Y-F	-11479 / 0	-91.8 -91.8 0.58 (1)	3.18
F-G	-11479 / 0	-91.8 -91.8 0.42 (1)	3.35
G-H	-11479 / 0	-91.8 -91.8 0.42 (1)	3.35
H-I	-8271 / 0	-91.8 -91.8 0.27 (1)	4.04
I-J	-4841 / 0	-91.8 -91.8 0.14 (1)	5.16
J-K	0 / 36	-91.8 -91.8 0.04 (1)	10.00
T-B	-4867 / 0	0.0 0.0 0.17 (1)	6.58
L-J	-3777 / 0	0.0 0.0 0.13 (1)	7.26
WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
S-C	-855 / 0	0.07 (1)	
C-R	0 / 6165	0.54 (1)	
R-D	-7588 / 0	0.65 (1)	
D-E	0 / 4919	0.43 (1)	
E-P	0 / 2086	0.18 (1)	
P-F	-1007 / 0	0.10 (1)	
F-M	-591 / 0	0.06 (1)	
M-S	0 / 5253	0.46 (1)	
S-J	0 / 4084	0.36 (1)	
J-I	0 / 5097	0.45 (1)	
I-H	0 / 3870	0.34 (1)	
N-H	-2696 / 0	0.28 (1)	

SPECIFIED CONCENTRATED LOADS (LBS)	
JT	LOC.
C	4-0-11 -41
C	4-0-11 -81
C	4-0-11 -173
E	11-6-8 -58
E	11-6-8 -246
P	18-6-8 -1402

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-11	-41	-	-	FRONT	VERT	DEAD	-	C1
C	4-0-11	-81	-	-	BACK	VERT	TOTAL	-	C1
C	4-0-11	-173	-	-	FRONT	VERT	SNOW	-	C1
E	11-6-8	-58	-	-	FRONT	VERT	DEAD	-	C1
E	11-6-8	-246	-	-	FRONT	VERT	SNOW	-	C1
P	18-6-8	-1402	-	-	BACK	VERT	TOTAL	-	C1

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.19")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.28")
ALLOWABLE DEFL.(TL)= L/360 (1.19")
CALCULATED VERT. DEFL.(TL) = L/ 831 (0.52")

CSI: TC=0.65/1.00 (C-D:1), BC=0.75/1.00 (P-R:1), WB=0.65/1.00 (D-R:1), SSI=0.23/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (D) (INPUT = 0.90)
JSI METAL= 0.96 (Q) (INPUT = 1.00)



Structural component only
DWG# T-2117663

JOB NAME 410918	TRUSS NAME T37	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri Jun 4 09:44:55 2021 Page 2
ID:GzzEEXDtkQt BH_M?wlmz?k45-3E?geA3ldQhPo3tCm4xALD7S157PILD1gRgLNtz94c

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	8.0	2.50	3.75
C	TTWW+m	MT20	8.0	9.0	3.75	1.75
D	TTW-h	MT20	6.0	9.0		
E	TTWW-m	MT20	6.0	9.0	3.00	3.25
F	TMW+w	MT20	3.0	6.0		
G	TS-t	MT20	5.0	6.0		
H	TMWW-t	MT20	5.0	6.0		
I	TTWW+m	MT20	8.0	9.0	Edge	5.75
J	TMVW-p	MT20	5.0	6.0	1.50	3.00
L	BMV1+p	MT20	3.0	6.0		
M	BMWW-t	MT20	5.0	6.0		
N	BMWW-t	MT20	5.0	6.0	2.50	2.50
O	BS-t	MT20	5.0	6.0		
P	BMWWW-t	MT20	6.0	9.0		
Q	BS-t	MT20	5.0	6.0		
R	BMWWW-t	MT20	6.0	12.0	2.50	4.50
S	BMWW-t	MT20	5.0	8.0	2.50	3.25
T	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

SPECIFIED CONCENTRATED LOADS (LBS)


JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
Q	14-1-4	-27	-27	---	BACK	VERT	TOTAL	---	C1
S	3-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
U	5-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
V	12-1-4	-114	-114	---	BACK	VERT	TOTAL	---	C1
W	14-1-4	-100	-100	---	BACK	VERT	TOTAL	---	C1
X	16-1-4	-100	-100	---	BACK	VERT	TOTAL	---	C1
Y	18-1-4	-100	-100	---	BACK	VERT	TOTAL	---	C1
Z	1-0-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
AA	1-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AB	5-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AC	8-1-4	-27	-27	---	BACK	VERT	TOTAL	---	C1
AD	10-1-4	-27	-27	---	BACK	VERT	TOTAL	---	C1
AE	12-1-4	-27	-27	---	BACK	VERT	TOTAL	---	C1
AF	16-1-4	-27	-27	---	BACK	VERT	TOTAL	---	C1
AG	18-1-4	-27	-27	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS
1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



JOB NAME 410918	TRUSS NAME T38	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri Jun 4 09:44:55 2021 Page 1
ID:GzzEEXDtfkQt_BH_M?wlmisz?k45-3E?geA3ldQhPo3tCm4xALD7XH5ELINM1gRgLntz9j4c

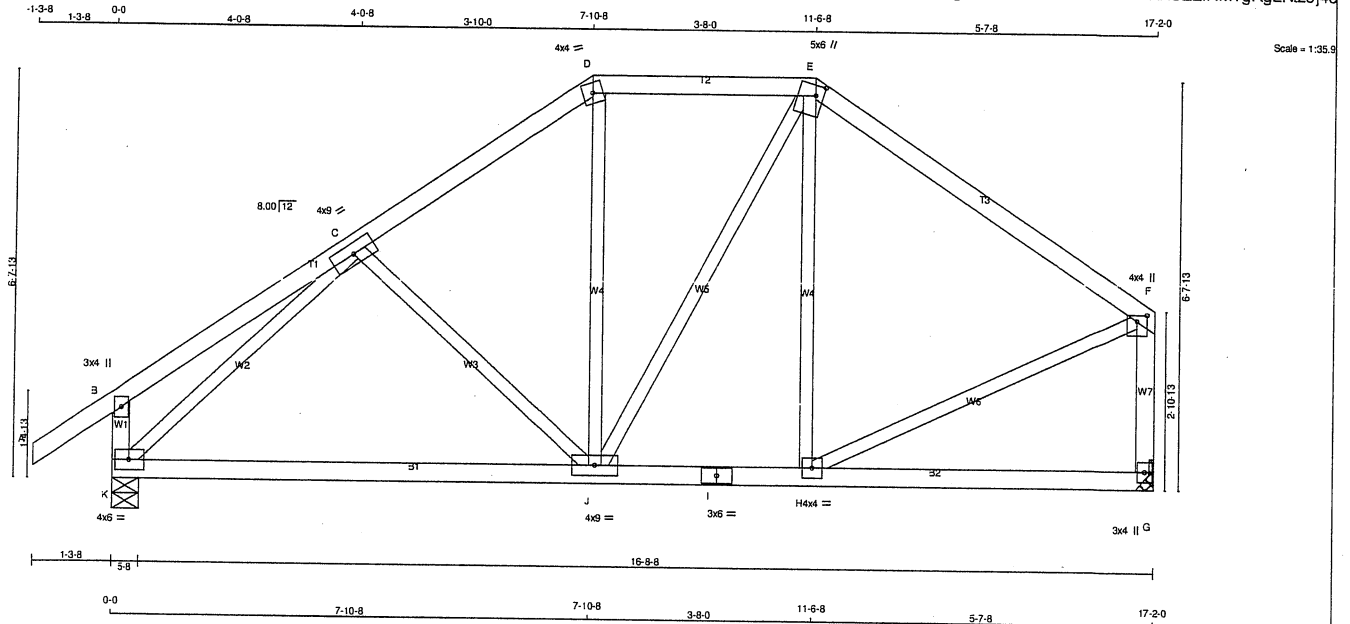

TOTAL WEIGHT = 77 lb
[M/F]

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER		
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
E - F	2x4	DRY	No.2	SPF	
K - B	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	
K - I	2x4	DRY	No.2	SPF	
I - G	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-t	MT20	4.0	9.0		
D	TTW-m	MT20	4.0	4.0		
E	TTWW+m	MT20	5.0	6.0	2.00	1.50
F	TMVW+p	MT20	4.0	4.0	1.25	2.00
G	BMV1+p	MT20	3.0	4.0		
H	BMVW-t	MT20	4.0	4.0		
I	BS-t	MT20	3.0	6.0		
J	BMVWW-t	MT20	4.0	9.0		
K	BMVW1-t	MT20	4.0	6.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQRD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
K	1072	0	1072	0
G	946	0	946	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN.	COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	756	509 / 0	0 / 0	0 / 0	0 / 0	247 / 0	0 / 0
G	669	439 / 0	0 / 0	0 / 0	0 / 0	230 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED		MEMB.	MAX. FACTORED		
	FORCE	VERT. LOAD	LC1 MAX		FORCE	MAX	
	(LBS)	(PLF)	CSI (LC)		(LBS)	CSI (LC)	
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	C-J	-197 / 0	0.10 (1)
B-C	0 / 23	-91.8	-91.8 0.23 (1)	10.00	J-D	0 / 127	0.03 (4)
C-D	-803 / 0	-91.8	-91.8 0.18 (1)	6.25	J-E	0 / 162	0.04 (1)
D-E	-650 / 0	-91.8	-91.8 0.16 (1)	6.25	H-E	-184 / 0	0.13 (1)
E-F	-690 / 0	-91.8	-91.8 0.38 (1)	6.25	K-C	-1089 / 0	0.51 (1)
K-B	-264 / 0	0.0	0.0 0.03 (1)	7.81	H-F	0 / 629	0.14 (1)
G-F	-900 / 0	0.0	0.0 0.14 (1)	7.81			
K-J	0 / 793	-18.5	-18.5 0.30 (4)	10.00			
J-I	0 / 570	-18.5	-18.5 0.29 (4)	10.00			
I-H	0 / 570	-18.5	-18.5 0.29 (4)	10.00			
H-G	0 / 0	-18.5	-18.5 0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.57")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.57")
CALCULATED VERT. DEFL.(TL) = L/999 (0.13")

CSI: TC=0.38/1.00 (E-F:1), BC=0.30/1.00 (J-K:4), WB=0.51/1.00 (C-K:1), SSI=0.17/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.65 (H) (INPUT = 0.90)
JSI METAL= 0.26 (I) (INPUT = 1.00)




Structural component only
DWG# T-2117664

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410918	T39	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri Jun 4 09:44:56 2021 Page 1
ID:GzzEEXDtfkQt_BH_M?wlmisz?k45-XQZ2rW3NNkpFQDSOJnSPtQgJTubS1uuBv5PuvJz9j4b

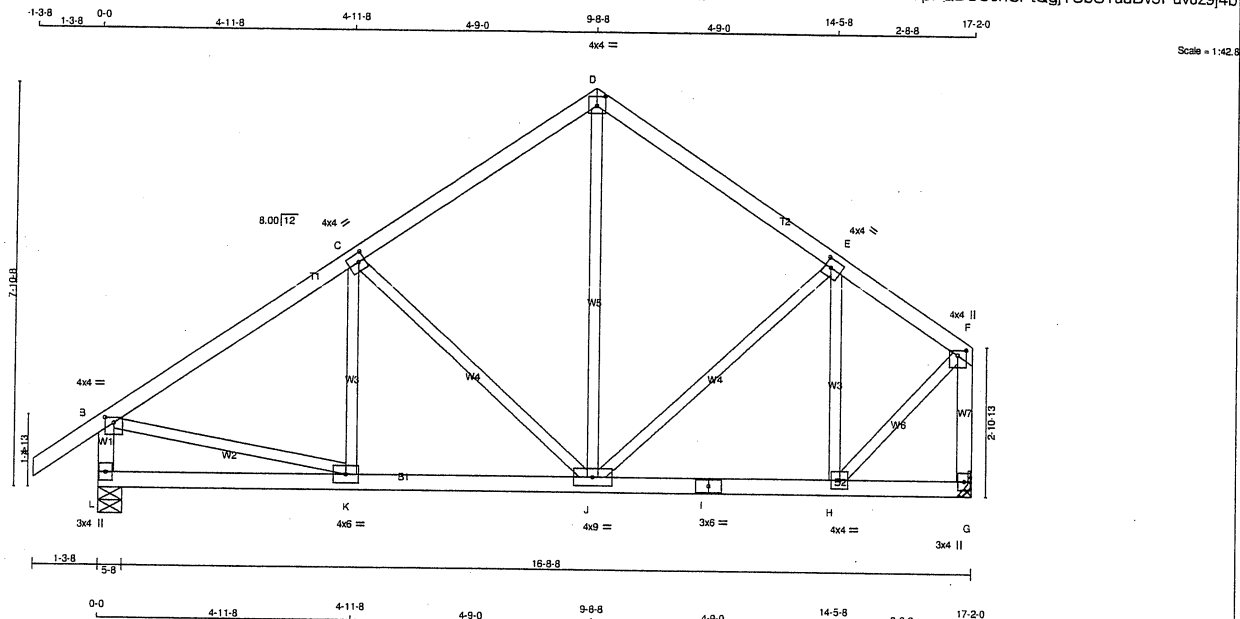

TOTAL WEIGHT = 2 X 78 = 157 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
L - B	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	
L - I	2x4	DRY	No.2	SPF	
I - G	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	4.0	1.25	2.00
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TTW-p	MT20	4.0	4.0	2.25	2.00
E	TMVW-t	MT20	4.0	4.0	2.00	1.50
F	TMVW-p	MT20	4.0	4.0	1.25	2.00
G	BMV1-p	MT20	3.0	4.0		
H	BMVW-t	MT20	4.0	4.0		
I	BS-t	MT20	3.0	6.0		
J	BMVWW-t	MT20	4.0	9.0		
K	BMVW-t	MT20	4.0	6.0		
L	BMV1-p	MT20	3.0	4.0		

NOTES: (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
L	1072	0	1072	0
G	946	0	946	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
L	756	509 / 0	0 / 0	0 / 0	0 / 0	0 / 0	247 / 0	0 / 0
G	669	439 / 0	0 / 0	0 / 0	0 / 0	0 / 0	230 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.97 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (LC)	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO						FR-TO			
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	K-C	-83 / 51	0.03 (1)	
B-C	-966 / 0	-91.8	-91.8	0.29 (1)	5.97	C-J	-402 / 0	0.30 (1)	
C-D	-671 / 0	-91.8	-91.8	0.28 (1)	6.25	J-D	0 / 369	0.08 (1)	
D-E	-662 / 0	-91.8	-91.8	0.24 (1)	6.25	E-J	-9 / 4	0.01 (1)	
E-F	-611 / 0	-91.8	-91.8	0.20 (1)	6.25	H-E	-439 / 0	0.14 (1)	
L-B	-1034 / 0	0.0	0.0	0.11 (1)	7.72	B-K	0 / 848	0.19 (1)	
G-F	-929 / 0	0.0	0.0	0.14 (1)	7.81	H-F	0 / 745	0.17 (1)	
L-K	0 / 0	-18.5	-18.5	0.10 (4)	10.00				
K-J	0 / 828	-18.5	-18.5	0.18 (1)	10.00				
J-I	0 / 540	-18.5	-18.5	0.13 (1)	10.00				
I-H	0 / 540	-18.5	-18.5	0.13 (1)	10.00				
H-G	0 / 0	-18.5	-18.5	0.06 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.57")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.02")
ALLOWABLE DEFL.(TL) = $L/360$ (0.57")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.04")

CSI: TC=0.29/1.00 (B-C:1), BC=0.18/1.00 (J-K:1), WB=0.30/1.00 (C-J:1), SS=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.84 (B) (INPUT = 0.90)
JSI METAL = 0.29 (B) (INPUT = 1.00)




Structural component only
DWG# T-2117665

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410918	T40	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri Jun 4 09:44:57 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wlmzs?k45-?c7R3s4081x61N1atVzeQeDwRutUmM3K8l9RRmz9j4a

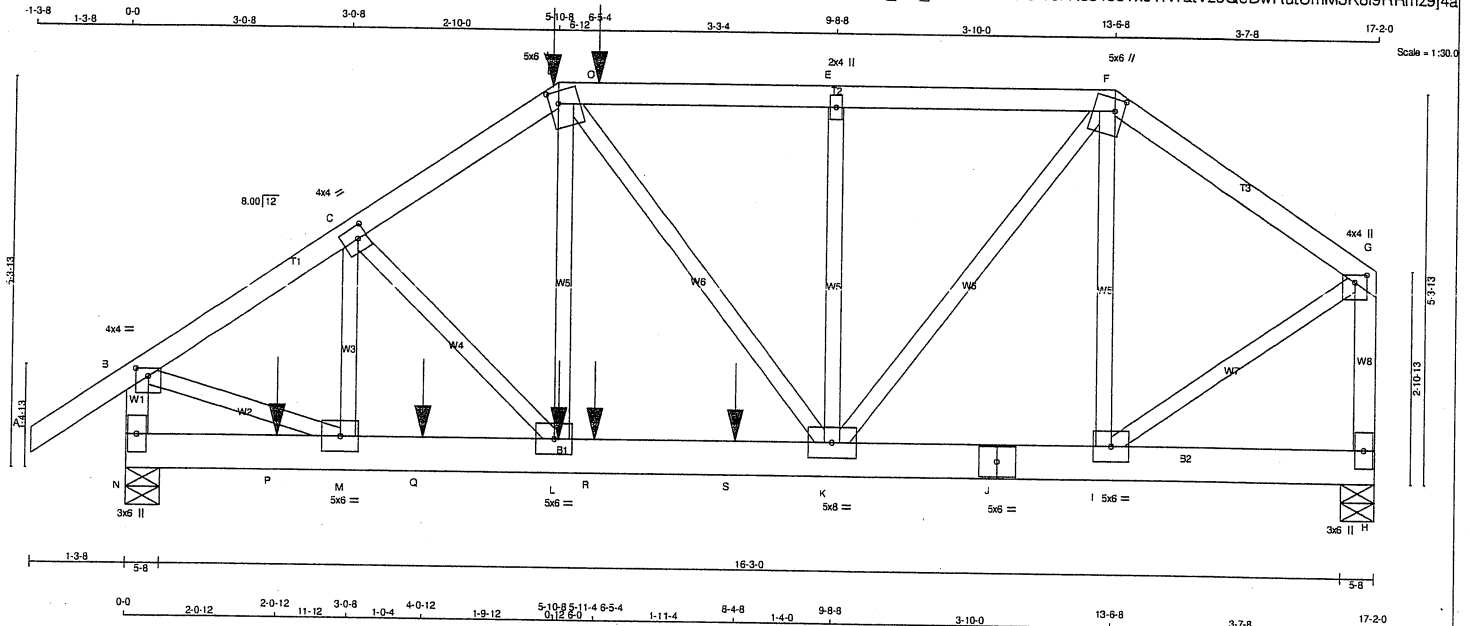

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4 DRY	No.2	SPF		
D - F	2x4 DRY	No.2	SPF		
F - G	2x4 DRY	No.2	SPF		
N - B	2x4 DRY	No.2	SPF		
H - G	2x4 DRY	No.2	SPF		
N - J	2x6 DRY	No.2	SPF		
J - H	2x6 DRY	No.2	SPF		

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - D 1	12	SIDE(61.0)
D - F 1	12	SIDE(61.0)
F - G 1	12	TOP
N - B 1	12	TOP
H - G 1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
N - J 2	12	SIDE(183.1)
J - H 2	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
L - D 1	6	SIDE(8.1)
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
		GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
N	2170	0	2170	0	0	5-8	5-8		
H	1745	0	1745	0	0	5-8	5-8		

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
N	1530	1028 / 0	0 / 0	0 / 0	0 / 0	502 / 0	0 / 0
H	1230	831 / 0	0 / 0	0 / 0	0 / 0	399 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.65 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		W E B S		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 35	-91.8	-91.8 0.07 (1)	10.00	M-C	-670 / 0	0.07 (1)
B-C	-2228 / 0	-91.8	-91.8 0.07 (1)	5.91	C-L	0 / 286	0.04 (1)
C-D	-2502 / 0	-91.8	-91.8 0.08 (1)	5.65	L-D	0 / 445	0.05 (1)
D-O	-2098 / 0	-91.8	-91.8 0.15 (1)	5.94	D-K	0 / 39	0.00 (1)
O-E	-2098 / 0	-91.8	-91.8 0.15 (1)	5.94	K-E	-453 / 0	0.09 (1)
E-F	-2098 / 0	-91.8	-91.8 0.15 (1)	5.94	K-F	0 / 1571	0.19 (1)
F-G	-1385 / 0	-91.8	-91.8 0.12 (1)	6.25	I-F	-775 / 0	0.16 (1)
N-B	-2096 / 0	0.0	0.0 0.12 (1)	7.65	B-M	0 / 1963	0.24 (1)
H-G	-1707 / 0	0.0	0.0 0.13 (1)	7.81	I-G	0 / 1384	0.17 (1)

N - P	0 / 0	-18.5	-18.5 0.04 (1)	10.00
P - M	0 / 0	-18.5	-18.5 0.04 (1)	10.00
M - Q	0 / 1865	-18.5	-18.5 0.22 (1)	10.00
Q - L	0 / 1865	-18.5	-18.5 0.22 (1)	10.00
L - R	0 / 2074	-18.5	-18.5 0.39 (1)	10.00
R - S	0 / 2074	-18.5	-18.5 0.39 (1)	10.00
S - K	0 / 2074	-18.5	-18.5 0.39 (1)	10.00
K - J	0 / 1134	-18.5	-18.5 0.17 (1)	10.00
J - I	0 / 1134	-18.5	-18.5 0.17 (1)	10.00
I - H	0 / 0	-18.5	-18.5 0.02 (4)	10.00

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
D	5-10-8	-344	-344	---	FRONT	VERT	TOTAL	---	C1
L	5-11-4	-29	-29	---	FRONT	VERT	TOTAL	---	C1
O	6-5-4	-136	-136	---	FRONT	VERT	TOTAL	---	C1
P	2-0-12	-29	-29	---	FRONT	VERT	TOTAL	---	C1
Q	4-0-12	-29	-29	---	FRONT	VERT	TOTAL	---	C1
R	6-5-4	-29	-29	---	FRONT	VERT	TOTAL	---	C1
S	8-4-8	-740	-740	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 90 = 179 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.57")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.03")
ALLOWABLE DEFL.(TL)= L/360 (0.57")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.06")

CSI: TC=0.15/1.00 (D-E:1), BC=0.39/1.00 (K-L:1),
WB=0.24/1.00 (B-M:1), SS=0.24/1.00 (K-L:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	650	371	1747
	788	1987	1873

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.85 (B) (INPUT = 0.90)
JSI METAL= 0.30 (B) (INPUT = 1.00)



Structural component only
DWG# T-2117666

CONTINUED ON PAGE 2

JOB NAME 410918	TRUSS NAME T40	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri Jun 4 09:44:57 2021 Page 2
ID:GzzEEXDtfkQt BH M?wlmsz?k45-?c7R3s4081x61N1atVzeQeDwRutUmM3K8l9RRmz9j4a

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	4.0	1.25	2.00
C	TMWW-t	MT20	4.0	4.0	2.00	1.50
D	TTWW+m	MT20	5.0	6.0	2.00	1.50
E	TMW+w	MT20	2.0	4.0		
F	TTWW+m	MT20	5.0	6.0	2.00	1.50
G	TMVW+p	MT20	4.0	4.0	1.25	2.00
H	BMV1+p	MT20	3.0	6.0		
I, L, M						
I	BMWW-t	MT20	5.0	6.0		
J	BS-t	MT20	5.0	6.0		
K	BMWWW-t	MT20	5.0	8.0		
N	BMV1+p	MT20	3.0	6.0		

NOTES: (i)


1) Lateral braces to be a minimum of 2x4 SPF #2



Structural component only
DWG# T-2117666 3/12

JOB NAME 410918	TRUSS NAME T41	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri Jun 4 09:44:58 2021 Page 1
ID:GzzEEXDtKQt_BH_M?wmsz?k45-TphpGC5evL3zfXcmRCUtzr40IIVr2UMPu?zCz9j4Z

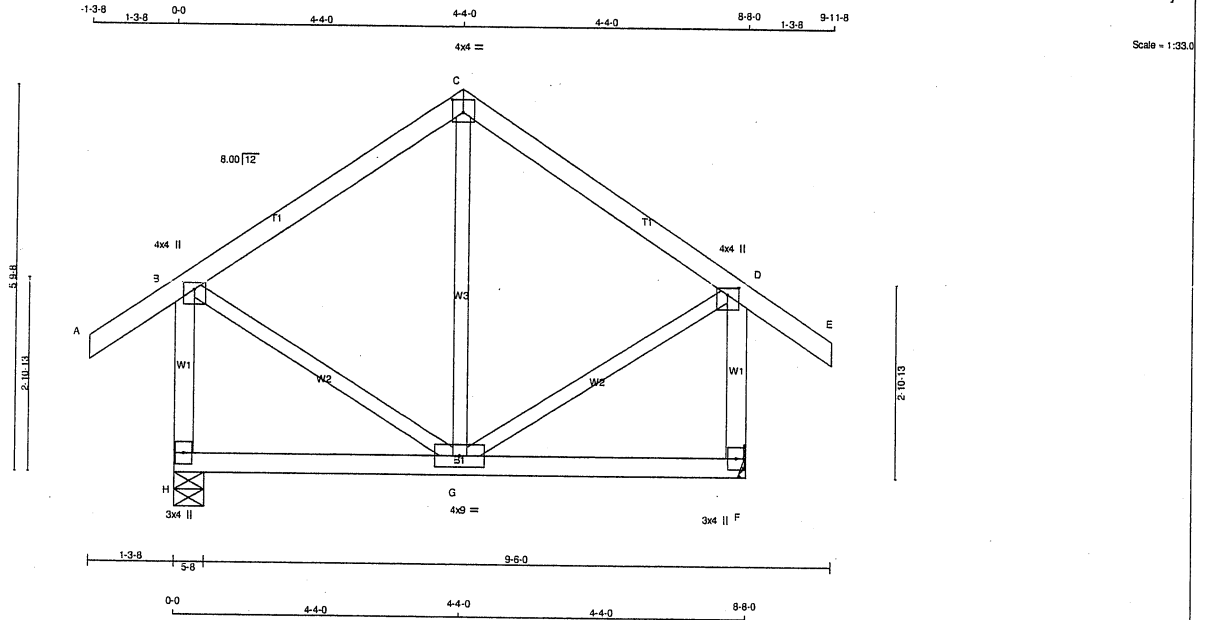

TOTAL WEIGHT = 43 lb
[M/F]

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
F - D	2x4	DRY	No.2
H - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
C	TTW-p	MT20	4.0	4.0	2.25	2.00
D	TMVW+p	MT20	4.0	4.0	1.25	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMWW-t	MT20	4.0	9.0		
H	BMV1+p	MT20	3.0	4.0		

NOTES: (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
H	604	0	604	0	0
F	604	0	604	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	425	292 / 0	0 / 0	0 / 0	0 / 0	0 / 0	133 / 0	0 / 0
F	425	292 / 0	0 / 0	0 / 0	0 / 0	0 / 0	133 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	G-C	-136 / 25	0.07 (1)	
B-C	-236 / 0	-91.8	-91.8 0.22 (1)	B-G	0 / 229	0.05 (1)	
C-D	-236 / 0	-91.8	-91.8 0.22 (1)	G-D	0 / 229	0.05 (1)	
D-E	0 / 35	-91.8	-91.8 0.12 (1)				
H-B	-573 / 0	0.0	0.0 0.09 (1)				
F-D	-573 / 0	0.0	0.0 0.09 (1)				
H-G	0 / 0	-18.5	-18.5 0.10 (4)				
G-F	0 / 0	-18.5	-18.5 0.10 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.29")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.29")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.22/1.00 (B-C:1), BC=0.10/1.00 (G-H:4),
WB=0.07/1.00 (C-G:1), SS=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.38 (B) (INPUT = 0.90)
JSI METAL= 0.11 (B) (INPUT = 1.00)




Structural component only
DWG# T-2117667

JOB NAME 410918	TRUSS NAME T42	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri Jun 4 09:44:59 2021 Page 1
ID:GzzEEXDtfkQt_BH_M?wlmz?k45-x?EBTY6GgBqHgBz?v?6V3IE0idaEHKdb3eYWez9j4Y

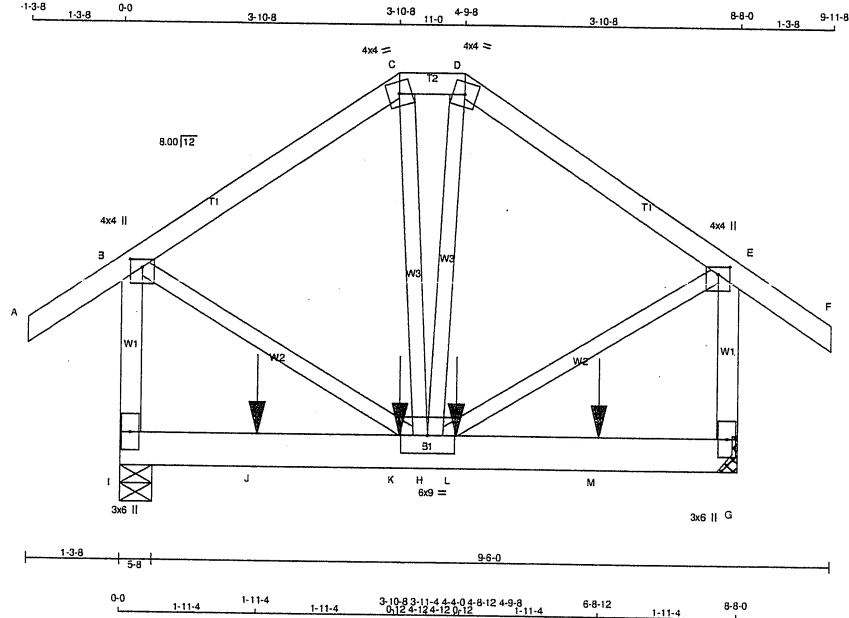

Scale = 1/32

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2	
C - D	2x4	DRY	No.2	
D - F	2x4	DRY	No.2	
I - B	2x4	DRY	No.2	
G - E	2x4	DRY	No.2	
I - G	2x6	DRY	No.2	

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
C	TTW-m	MT20	4.0	4.0		
D	TTW-m	MT20	4.0	4.0		
E	TMVW+p	MT20	4.0	4.0	1.25	2.00
G	BMV1+p	MT20	3.0	6.0		
H	BMVWWW-I	MT20	6.0	9.0		
I	BMV1+p	MT20	3.0	6.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	GROSS REACTION	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
I	974	0	974	0	5-8
G	974	0	974	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN.	COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
I	684	478 / 0	0 / 0	0 / 0	0 / 0	206 / 0	0 / 0	
G	684	478 / 0	0 / 0	0 / 0	0 / 0	206 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED	FORCE (LBS)	VERT. LOAD	LC1	MAX	MAX.	MEMB.	WEBS	MAX. FACTORED	FORCE (LBS)	MAX
FR-TO								FR-TO				
A-B	0 / 35	-91.8	-91.8	0.14	(1)	10.00		B-H	0 / 522	0.13	(1)	
B-C	-545 / 0	-91.8	-91.8	0.27	(1)	6.25		H-E	0 / 522	0.13	(1)	
C-D	-460 / 0	-91.8	-91.8	0.02	(1)	6.25		C-H	0 / 84	0.02	(4)	
D-E	-545 / 0	-91.8	-91.8	0.27	(1)	6.25		H-D	0 / 84	0.02	(4)	
E-F	0 / 35	-91.8	-91.8	0.14	(1)	10.00						
I-B	-868 / 0	0.0	0.0	0.13	(1)	7.81						
G-E	-868 / 0	0.0	0.0	0.13	(1)	7.81						
I-J	0 / 0	-18.5	-18.5	0.15	(1)	10.00						
J-K	0 / 0	-18.5	-18.5	0.15	(1)	10.00						
K-H	0 / 0	-18.5	-18.5	0.15	(1)	10.00						
H-L	0 / 0	-18.5	-18.5	0.15	(1)	10.00						
L-M	0 / 0	-18.5	-18.5	0.15	(1)	10.00						
M-G	0 / 0	-18.5	-18.5	0.15	(1)	10.00						

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
J	1-11-4	-123	-123		BACK	VERT	TOTAL		C1
K	3-11-4	-136	-136		BACK	VERT	TOTAL		C1
L	4-8-12	-136	-136		BACK	VERT	TOTAL		C1
M	6-8-12	-123	-123		BACK	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 51 lb

[M]

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.29")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.29")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.27/1.00 (B-C:1), BC=0.15/1.00 (G-H:1), WB=0.13/1.00 (E-H:1), SSI=0.23/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MT20	650	371	1747
	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.58 (B) (INPUT = 0.90)
JSI METAL= 0.17 (B) (INPUT = 1.00)




Structural component only
DWG# T-2117668

JOB NAME 410918	TRUSS NAME T43S	QUANTITY 2	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri Jun 4 09:45:00 2021 Page 1
ID:GzzEEXDtfkQt_BH_M?wmsz?k45-PBoZht7uRyJhuqm9YdWL2GrRP6?hzm5mqjN524z9j4X

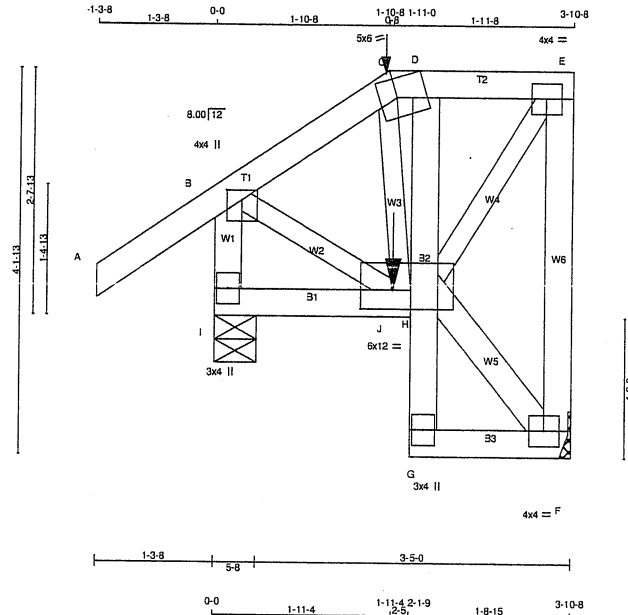

Scale = 1/2\"/>

LUMBER				N. L. G. A. RULES	
CHORDS	SIZE	LUMBER	DESCR.	SPF	SPF
A - C	2x4	DRY	No.2	SPF	SPF
C - E	2x4	DRY	No.2	SPF	SPF
F - E	2x4	DRY	No.2	SPF	SPF
I - B	2x4	DRY	No.2	SPF	SPF
I - H	2x4	DRY	No.2	SPF	SPF
G - D	2x4	DRY	No.2	SPF	SPF
G - F	2x4	DRY	No.2	SPF	SPF
ALL WEBS	2x3	DRY	No.2	SPF	SPF
EXCEPT					
H - F	2x4	DRY	No.2	SPF	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
C	TTVW-m	MT20	5.0	6.0	Edge	3.75
D	TMVW-t	MT20	4.0	4.0		
F	BMVW1-t	MT20	4.0	4.0		
G	BMV+p	MT20	3.0	4.0		
H	BMVWWWW*	MT20	6.0	12.0	2.50	4.00
I	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED		MAXIMUM FACTORED		INPUT	REQRD
	GROSS REACTION		GROSS REACTION			
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX
F	194	0	194	0	MECHANICAL	
I	364	0	364	0	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
F	138	87/-12	0/0	0/0	0/0	51/0	0/0
I	255	182/0	0/0	0/0	0/0	73/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (9)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0/35	-91.8	-91.8 0.16 (5)	10.00	H-F	-4/0	0.00 (1)
B-C	-113/0	-91.8	-91.8 0.16 (5)	6.25	H-E	0/130	0.03 (1)
C-D	-75/0	-91.8	-91.8 0.01 (1)	6.25	C-H	0/84	0.02 (6)
D-E	-73/0	-91.8	-91.8 0.04 (6)	6.25	B-H	0/81	0.02 (1)
F-E	-176/0	0.0	0.0 0.05 (1)	7.81			
I-B	-343/0	0.0	0.0 0.04 (1)	7.81			
I-J	0/0	-18.5	-18.5 0.03 (4)	10.00			
J-H	0/0	-18.5	-18.5 0.03 (4)	10.00			
G-H	0/17	0.0	0.0 0.01 (1)	10.00			
H-D	-117/0	0.0	0.0 0.01 (1)	7.81			
G-F	0/3	-18.5	-18.5 0.02 (4)	10.00			

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	1-11-0	1	1	77	BACK	VERT	TOTAL	---	C1
J	1-11-4	-4	-4	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 2 X 28 = 56 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.16/1.00 (A-B:5) , BC=0.03/1.00 (H-I:4) , WB=0.03/1.00 (E-H:1) , SSI=0.11/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	650	371	1747
	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.23 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)




Structural component only
DWG# T-2117669

JOB NAME 410918	TRUSS NAME T44S	QUANTITY 2	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
---------------------------	---------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri Jun 4 09:45:01 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wmsz?k45-tNMxuD7WCGRYW_LL6K2aaUncWVL?iD6w3N7faXz9j4W

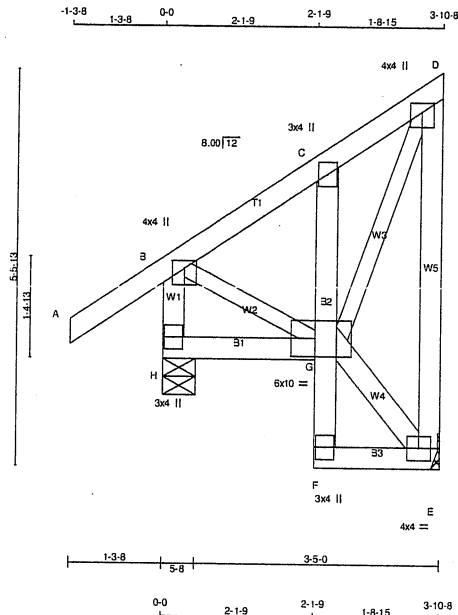

Scale = 1:30.4

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER		
H - B	2x4	DRY	No.2	SPF	
A - D	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	
H - G	2x4	DRY	No.2	SPF	
F - C	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
G - E	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
C	TMV+p	MT20	3.0	4.0		
D	TMVW+p	MT20	4.0	4.0	1.50	2.00
E	BMVW1-t	MT20	4.0	4.0		
F	BMV+p	MT20	3.0	4.0		
G	BVMWWW-t	MT20	6.0	10.0	3.00	4.00
H	BMV1+p	MT20	3.0	4.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
H	340	0	340	0	5-8	5-8
E	214	0	214	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
H	238	169 / 0	0 / 0	0 / 0	0 / 0	68 / 0	0 / 0
E	151	99 / 0	0 / 0	0 / 0	0 / 0	52 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO		FR-TO		
H-B	-319 / 0	0.0	0.0	0.03 (1)	7.81	B-G	0 / 105
A-B	0 / 35	-91.8	-91.8	0.14 (5)	10.00	G-E	-9 / 0
B-C	-105 / 0	-91.8	-91.8	0.05 (1)	6.25	G-D	0 / 210
C-D	-113 / 0	-91.8	-91.8	0.05 (1)	6.25		
E-D	-192 / 0	0.0	0.0	0.10 (1)	7.81		
H-G	0 / 0	-18.5	-18.5	0.03 (4)	10.00		
F-G	0 / 17	0.0	0.0	0.02 (1)	10.00		
G-C	-209 / 0	0.0	0.0	0.02 (1)	7.81		
F-E	0 / 7	-18.5	-18.5	0.01 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 2 X 29 = 59 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = **24.0** IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.14/1.00 (A-B:5), BC=0.03/1.00 (G-H:4),
WB=0.05/1.00 (D-G:1), SSI=0.09/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	650	371	1747
	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.21 (B) (INPUT = 0.90)

JSI METAL= 0.07 (C) (INPUT = 1.00)




Structural component only
DWG# T-2117670

JOB NAME 410918	TRUSS NAME T45	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri Jun 4 09:45:02 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wlmz?k45-MawK6Z88zaaP88wYg2Zp7hwoQvf7Rea3H1sC6zz9j4V

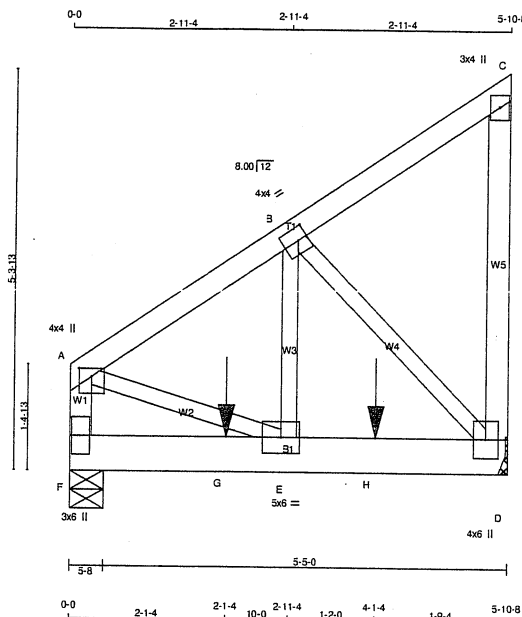

Scale = 1/2\"/>

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122\"X3\") SPIRAL NAILS		
F - A	12	TOP
A - C	12	TOP
C - D	12	TOP
BOTTOM CHORDS : (0.122\"X3\") SPIRAL NAILS		
F - D	12	SIDE(0.0)
WEBS : (0.122\"X3\") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TMVW-t	MT20	4.0	4.0	2.00	1.50
C	TMV+p	MT20	3.0	4.0		
D	BMVW1+p	MT20	4.0	6.0		
E	BMVW-t	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	DOWN	IN-SX	IN-SX
F	1114	0	5-8	5-8
D	1075	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	782	545 / 0	0 / 0	0 / 0	0 / 0	237 / 0	0 / 0
D	755	525 / 0	0 / 0	0 / 0	0 / 0	229 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 MAX. CSI (LC)	
FR-TO		FROM	TO	FR-TO			
F-A	-918 / 0	0.0	0.0 0.05 (1)	7.81	A-E	0 / 852	0.11 (1)
A-B	-954 / 0	-91.8	-91.8 0.07 (1)	6.25	E-B	0 / 1023	0.13 (1)
B-C	-16 / 0	-91.8	-91.8 0.06 (1)	6.25	B-D	-1145 / 0	0.16 (1)
D-C	-106 / 0	0.0	0.0 0.02 (1)	7.81			
F-G	0 / 0	-18.5	-18.5 0.14 (1)	10.00			
G-E	0 / 0	-18.5	-18.5 0.14 (1)	10.00			
E-H	0 / 807	-18.5	-18.5 0.16 (1)	10.00			
H-D	0 / 807	-18.5	-18.5 0.16 (1)	10.00			

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	2-1-4	-669	-669	---	FRONT	VERT	TOTAL	---	C1
H	4-1-4	-410	-410	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 32 = 64 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.07/1.00 (A-B:1), BC=0.16/1.00 (D-E:1), WB=0.16/1.00 (B-D:1), SSI=0.27/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.61 (B) (INPUT = 0.90)

JSI METAL= 0.18 (D) (INPUT = 1.00)



Structural component only
DWG# T-2117671

CONTINUED ON PAGE 2

JOB NAME 410918	TRUSS NAME T45	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	---	----------

Tamarack Roof Truss, Burlington


Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri Jun 4 09:45:02 2021 Page 2
ID:GzzEEEXDtfkQt BH M?wlmsz?k45-MawK6Z88zaaP88wYq2Zp7hwoQvf7Rea3H1sC6zz9i4V

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
F	BMV1+p	MT20	3.0	6.0		


NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

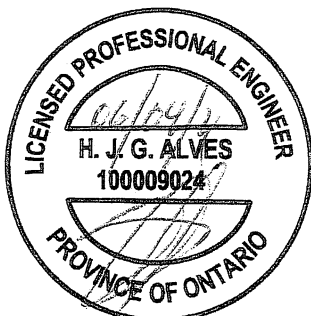

Structural component only
DWG# T-2117671

JOB NAME 410918	TRUSS NAME T46	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.420 S Jan 21 2021 Mittek Industries, Inc. Fri Jun 4 09:45:02 2021 Page 1 ID:GzzEEEXDtKQt_BH_M?wImSz?k45-MawK6Z88zaaP88wYg2Zp7hwo3vcWRcg3H1sC6zz9j4V	

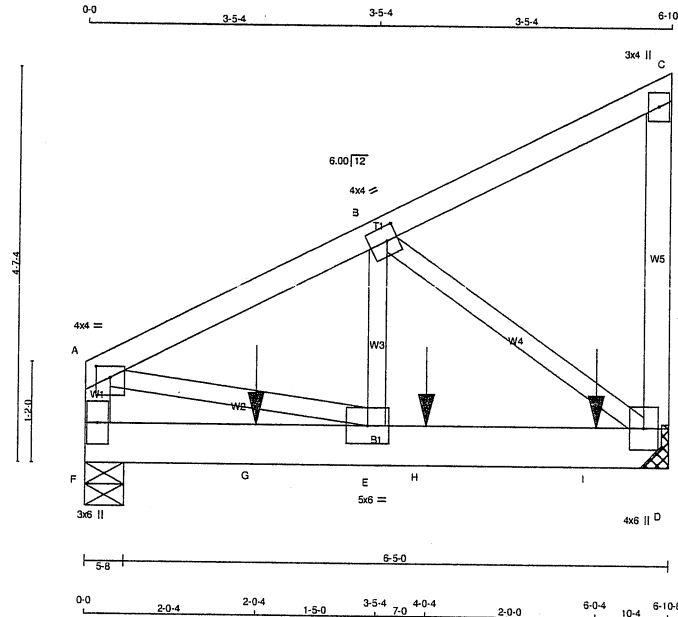

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F - A	12	TOP
A - C	12	TOP
C - D	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D	12	SIDE (0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-p	MT20	4.0	4.0	1.50	2.00
B	TMVW-t	MT20	4.0	4.0	2.00	1.50
C	TMV+p	MT20	3.0	4.0		
D	BMVW1+p	MT20	4.0	6.0		
E	BMVW-t	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
F	1535	0	1535	0
D	2008	0	2008	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	1083	723 / 0	0 / 0	0 / 0	0 / 0	360 / 0	0 / 0
D	1417	947 / 0	0 / 0	0 / 0	0 / 0	471 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO		FR-TO		
F - A	-1274 / 0	0.0	0.0 0.07 (1)	7.81	A - E	0 / 1620	0.20 (1)
A - B	-1754 / 0	-91.8	-91.8 0.09 (1)	6.25	E - B	0 / 1562	0.19 (1)
B - C	-13 / 0	-91.8	-91.8 0.08 (1)	6.25	B - D	-1953 / 0	0.28 (1)
D - C	-128 / 0	0.0	0.0 0.02 (1)	7.81			
F - G	0 / 0	-18.5	-18.5 0.19 (1)	10.00			
G - E	0 / 0	-18.5	-18.5 0.19 (1)	10.00			
E - H	0 / 1581	-18.5	-18.5 0.33 (1)	10.00			
H - I	0 / 1581	-18.5	-18.5 0.33 (1)	10.00			
I - D	0 / 1581	-18.5	-18.5 0.33 (1)	10.00			

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	2-0-4	-654	-654	---	BACK	VERT	TOTAL	---	C1
H	4-0-4	-654	-654	---	BACK	VERT	TOTAL	---	C1
I	6-0-4	-656	-656	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 34 = 67 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.23")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.01")
ALLOWABLE DEFL.(TL) = $L/360$ (0.23")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.03")

CSI: TC=0.09/1.00 (A-B:1), BC=0.33/1.00 (D-E:1), WB=0.28/1.00 (B-D:1), SSI=0.39/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (B) (INPUT = 0.90)
JSI METAL= 0.36 (D) (INPUT = 1.00)



Structural component only
DWG# T-2117672

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410918	T46	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri Jun 4 09:45:02 2021 Page 2
ID:GzzEEEXDtfkQt BH M?wlmsz?k45-MawK6Z88zaaP88wYg2Zp7hwo3vcWRcg3H1sC6zz9j4V

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
F	BMV1+p	MT20	3.0	6.0		

NOTES-


- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2



Structural component only
DWG# T-2117672 *2/2*

JOB NAME 410914	TRUSS NAME JC01	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 13:22:09 2021 Page 1
ID:GzzEEXDtKQt_BH_M?wimsz?k45-5apMgkCvbU_AaW1nTqI0Je_y73_wt9?_IOyJzfzEHCy

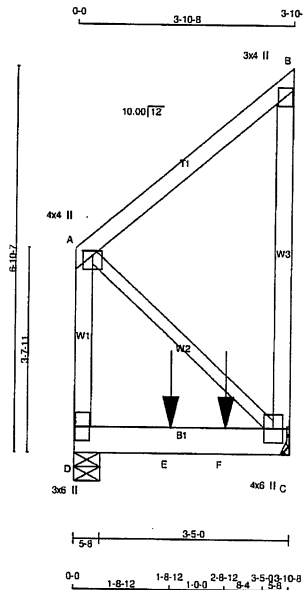

Scale = 1/32" = 1'-0"

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N. L. G. A. RULES				
D - A	2x4	DRY	No.2	SPF
A - B	2x4	DRY	No.2	SPF
C - B	2x4	DRY	No.2	SPF
D - C	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
D-A 1	12	TOP
A-B 1	12	TOP
B-C 1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
D-C 2	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.00	2.00
B	TMV+p	MT20	3.0	4.0		
C	BMVW1+p	MT20	4.0	6.0		
D	BMV1+p	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	UP/LIFT	IN-SX
D	539	0	5-8	5-8
C	655	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT C. MINIMUM BEARING LENGTH AT JOINT C = 2-0.

UNFACTORED REACTIONS

1ST CASE	MAX./MIN. COMPONENT REACTIONS
JT	COMBINED
D	380
C	461

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MEMB.	FORCE (LBS)
FR-TO			FR-TO	
D-A	-178 / 0	0.0	A-C	0 / 0
A-B	0 / 0	-91.8		
C-B	-178 / 0	0.0		
D-E	0 / 0	-18.5		
E-F	0 / 0	-18.5		
F-C	0 / 0	-18.5		

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	1-8-12	-269	-269	---	FRONT	VERT	TOTAL	---	C1
F	2-8-12	-269	-269	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 27 = 54 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSH: TC=0.13/1.00 (A-B:1), BC=0.22/1.00 (C-D:1),
WB=0.00/1.00 (A-C:1), SS=0.16/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.07 (A) (INPUT = 0.90)
JSI METAL= 0.03 (B) (INPUT = 1.00)

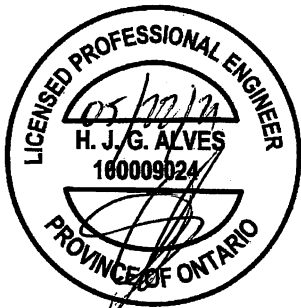


Structural component only
DWG# T-2115213

CONTINUED ON PAGE 2

JOB NAME 410918	TRUSS NAME J1	QUANTITY 13	PLY 1	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
---------------------------	-------------------------	-----------------------	-----------------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri May 21 15:05:56 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wlmssz?k45-GYaQazZu7jWe8TaZl6zGBnO0ECGBMRZYehsJ1EzEfh

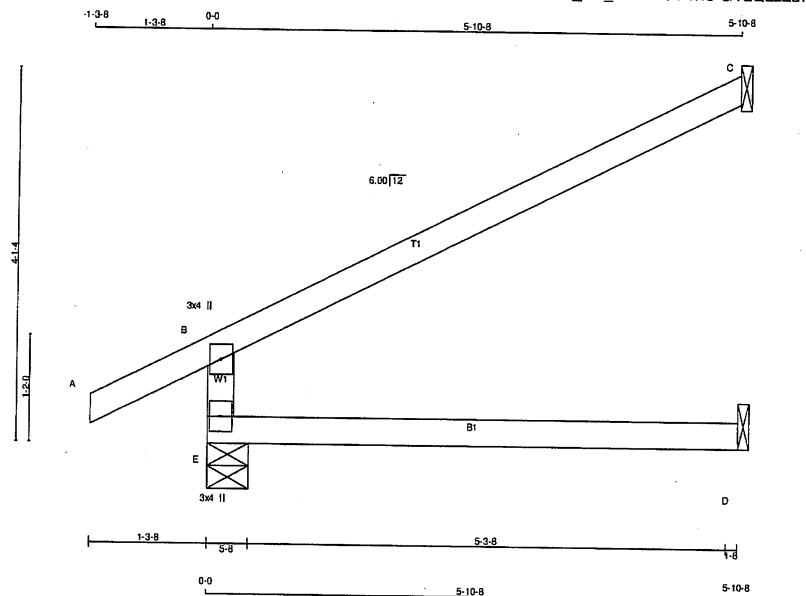

Scale = 1/2" = 1'-0"

TOTAL WEIGHT = 13 X 17 = 218 lb [M]

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
E	525	0	525	0	5-8	5-8
C	202	0	202	0	1-8	1-8
D	45	0	50	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX./MIN. COMPONENT REACTIONS					SOIL
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	
E	369	257 / 0	0 / 0	0 / 0	0 / 0	111 / 0	0 / 0
C	139	113 / 0	0 / 0	0 / 0	0 / 0	26 / 0	0 / 0
D	36	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS			WEBS		
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 MAX (LC)	MAX. UNBRACED LENGTH FR-TO	MEMB. MAX. FACTORED FORCE (LBS)	MAX LC1 MAX (LC)
FR-TO		FROM TO				
E-B	-461 / 0	0.0	0.0 0.13 (4)	7.81		
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00		
B-C	-30 / 0	-91.8	-91.8 0.54 (1)	6.25		
E-D	0 / 0	-18.5	-18.5 0.13 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2015, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.03")

CSI: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	650	371	1747
	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (E) (INPUT = 0.90)
JSI METAL= 0.13 (B) (INPUT = 1.00)

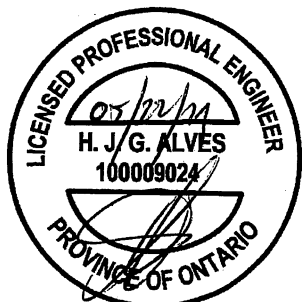

Structural component only
DWG# T-2115243

JOB NAME

410914

TRUSS NAME

J1S

QUANTITY

8

PLY

1

JOB DESC.

ROYAL PINE HOMES

DRWG NO.

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 13:22:03 2021 Page 1

ID:GzzEEEXDtfkQt_BH_M?wlmisz?k45-GQS5Ph78?eD1sbad7aec3NkvOeufTRC6NSV?m?zEHD2

LUMBER

N. L. G. A. RULES

CHORDS

SIZE

LUMBER

DESCR.

SPF

FACTORED

GROSS REACTION

MAXIMUM FACTORED

GROSS REACTION

INPUT

REQD

BRG

BRG

IN-SX

IN-SX

1

463

0

463

0

0

5-8

5-8

2

192

0

192

0

1-8

1-8

3

118

0

118

0

1-8

1-8

ALL WEBS

2x3

DRY

No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT

TYPE

PLATES

W

LEN

Y

X

B

TMVW-t

MT20

4.0

4.0

2.00

1.25

C

TMVW-t

MT20

4.0

4.0

2.00

1.25

F

BMV-w

MT20

3.0

6.0

G

BMV-t

MT20

3.0

4.0

H

BMVW-t

MT20

4.0

4.0

I

BMV1+p

MT20

3.0

4.0

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED

GROSS REACTION

MAXIMUM FACTORED

GROSS REACTION

INPUT

REQD

BRG

BRG

IN-SX

IN-SX

JT

VERT

HORZ

DOWN

HORZ

UPLIFT

IN-SX

IN-SX

I

463

0

463

0

0

5-8

5-8

D

192

0

192

0

1-8

1-8

E

118

0

118

0

1-8

1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) D, E

UNFACTORED REACTIONS

1ST LCASE

MAX./MIN. COMPONENT REACTIONS

JT

COMBINED

SNOW

LIVE

PERM.LIVE

WIND

DEAD

SOIL

I

325

228 / 0

0 / 0

0 / 0

0 / 0

97 / 0

0 / 0

D

133

103 / 0

0 / 0

0 / 0

0 / 0

30 / 0

0 / 0

E

86

39 / 0

0 / 0

0 / 0

0 / 0

47 / 0

0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS

MAX. FACTORED

FACTORED

VERT. LOAD

LC1

MAX

MAX.

MEMB.

MAX. FACTORED

WEBS

MAX. FACTORED

FR-TO

MEMB.

FORCE

VERT.

PLF

CSI

LC

UNBRAC

LENGTH

FR-TO

MEMB.

FORCE

MAX

CSI

LC

I-B

-448 / 0

0.0

0.0

0.05

(1)

7.81

I-H

0 / 223

0.05

(1)

A-B

0 / 28

-91.8

-91.8

0.12

(1)

10.00

C-F

-522 / 0

0.08

(1)

B-C

-241 / 0

-91.8

-91.8

0.12

(1)

6.25

C-D

0 / 3

-91.8

-91.8

0.27

(1)

10.00

I-H

0 / 0

-18.5

-18.5

0.01

(4)

10.00

H-G

-88 / 0

0.0

0.0

0.27

(1)

7.81

G-C

0 / 63

0.0

0.0

0.28

(1)

10.00

G-F

0 / 486

-18.5

-18.5

0.40

(1)

10.00

F-E

0 / 0

-18.5

-18.5

0.32

(1)

10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019

- PART 9 OF CBC 2012 (2019 AMENDMENT)

- CSA 086-14

- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")

CALCULATED VERT. DEFL.(LL) = L/999 (0.05")

ALLOWABLE DEFL.(TL)= L/360 (0.20")

CALCULATED VERT. DEFL.(TL) = L/625 (0.11")

CSI: TC=0.27/1.00 (C-D:1), BC=0.40/1.00 (F-G:1), WB=0.08/1.00 (C-F:1), SI=0.23/1.00 (C-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.42 (C) (INPUT = 0.90)

JSI METAL= 0.16 (G) (INPUT = 1.00)

LICENSED PROFESSIONAL ENGINEER

H. J. G. ALVES

100009024


PROVINCE OF ONTARIO

Structural component only

DWG# T-2115207

JOB NAME 410914	TRUSS NAME J2	QUANTITY 6	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri May 21 13:22:04 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wlmisz?k45-kd0Tc18mmxLuT19qgH9rcal6a2G6Ct4Fb6FYJRzEH01

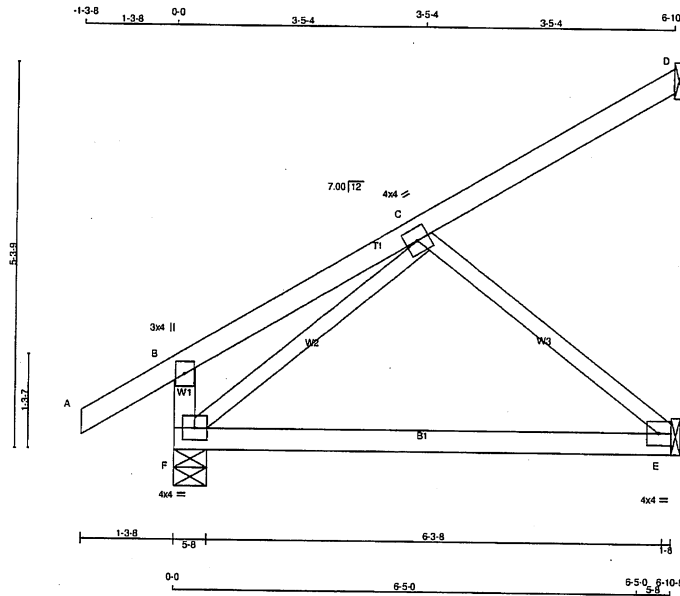

Scale = 1/28.8

LUMBER	N.L.G.A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF	
A - D	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
ALL WEBS 2x3 DRY					
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWV-t	MT20	4.0	4.0		
E	BMWV-t	MT20	4.0	4.0	2.00	Edge
F	BMWV-t	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES: (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
F	501	0	501	0	5-8	5-8
D	126	0	126	0	1-8	1-8
E	255	0	255	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) D, E

JT	UNFACTORED REACTIONS		LIVE	PERM. LIVE	WIND	DEAD	SOIL
	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
F	352	244 / 0	0 / 0	0 / 0	0 / 0	108 / 0	0 / 0
D	86	70 / 0	0 / 0	0 / 0	0 / 0	16 / 0	0 / 0
E	183	107 / 0	0 / 0	0 / 0	0 / 0	75 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH			
FR-TO		FROM TO		FR-TO					
F-B	-239 / 0	0.0 0.0	0.02 (1) 7.81	C-E	-298 / 0	0.11 (1)			
A-B	0 / 32	-91.8 -91.8	0.12 (1) 10.00	F-C	-302 / 0	0.10 (1)			
B-C	0 / 20	-91.8 -91.8	0.18 (1) 10.00						
C-D	-19 / 0	-91.8 -91.8	0.14 (1) 6.25						
F-E	0 / 228	-18.5 -18.5	0.26 (4) 10.00						

TOTAL WEIGHT = 6 X 27 = 160 lb [M/F]

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL(TL) = L/360 (0.23")
CALCULATED VERT. DEFL(TL) = L/850 (0.10")

CSI: TC=0.18/1.00 (B-C:1), BC=0.28/1.00 (E-F:4), WB=0.11/1.00 (C-E:1), SSI=0.13/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.27 (C) (INPUT = 0.90)
JSI METAL= 0.08 (E) (INPUT = 1.00)



Structural component only
DWG# T-2115208

JOB NAME 410914	TRUSS NAME J3	QUANTITY 4	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.420 S Jan 21 2021 Mittek Industries, Inc. Fri May 21 13:22:05 2021 Page 1
ID:GzzEEXDtKt BH_M?wlmSz?k45-DparqN9PXfUk5vk0E?g49oqGUSf8xL0Pqm_6ruzEH00

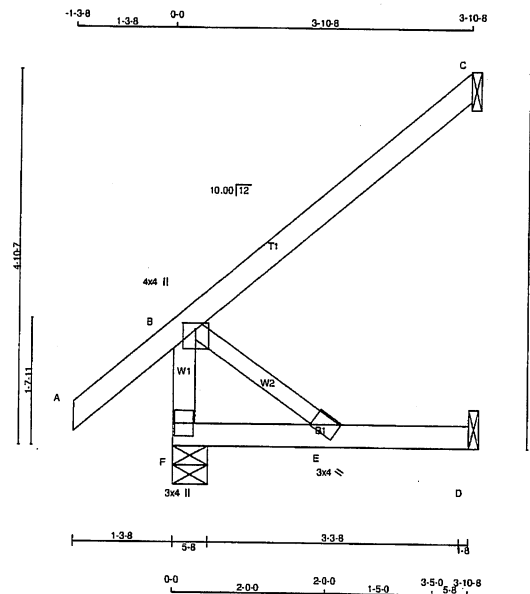

Scale = 1:27.3

LUMBER				TOTAL WEIGHT = 4 X 16 = 62 lb			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.	SPF	BRG	REQD	
CHORDS							
F - B	2x4	DRY	No.2	SPF			
A - C	2x4	DRY	No.2	SPF			
F - D	2x4	DRY	No.2	SPF			
ALL WEBS	2x3	DRY	No.2	SPF			
DRY: SEASONED LUMBER.							

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
E	BMVW+w	MT20	3.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
F	341	341	0	5-8
C	178	178	0	1-8
D	36	40	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX./MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
F	239	170 / 0	0 / 0	0 / 0	69 / 0	0 / 0
C	122	99 / 0	0 / 0	0 / 0	23 / 0	0 / 0
D	29	0 / 0	0 / 0	0 / 0	29 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO		FR-TO			
F-B	-305 / 0	0.0	0.03 (1)	B-E	0 / 0	0.00 (1)	
A-B	0 / 41	-91.8	-91.8 0.14 (5)				
B-C	0 / 0	-91.8	-91.8 0.23 (1)				
F-E	0 / 0	-18.5	-18.5 0.08 (4)				
E-D	0 / 0	-18.5	-18.5 0.08 (4)				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= L/999 (0.01")

CSI: TC=0.23/1.00 (B-C:1), BC=0.08/1.00 (E-F:4),
WB=0.09/1.00 (B-E:1), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	650	371	1747

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.22 (B) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2115209

JOB NAME 410918	TRUSS NAME J4	QUANTITY 4	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri May 21 15:05:57 2021 Page 1
ID:GzzEEEXdtKtQ_BH_M?wlmSZ?k45-kl8onJaWu1eVld9UjUVk?x0D0cdt5upitLbtZgzEFhe

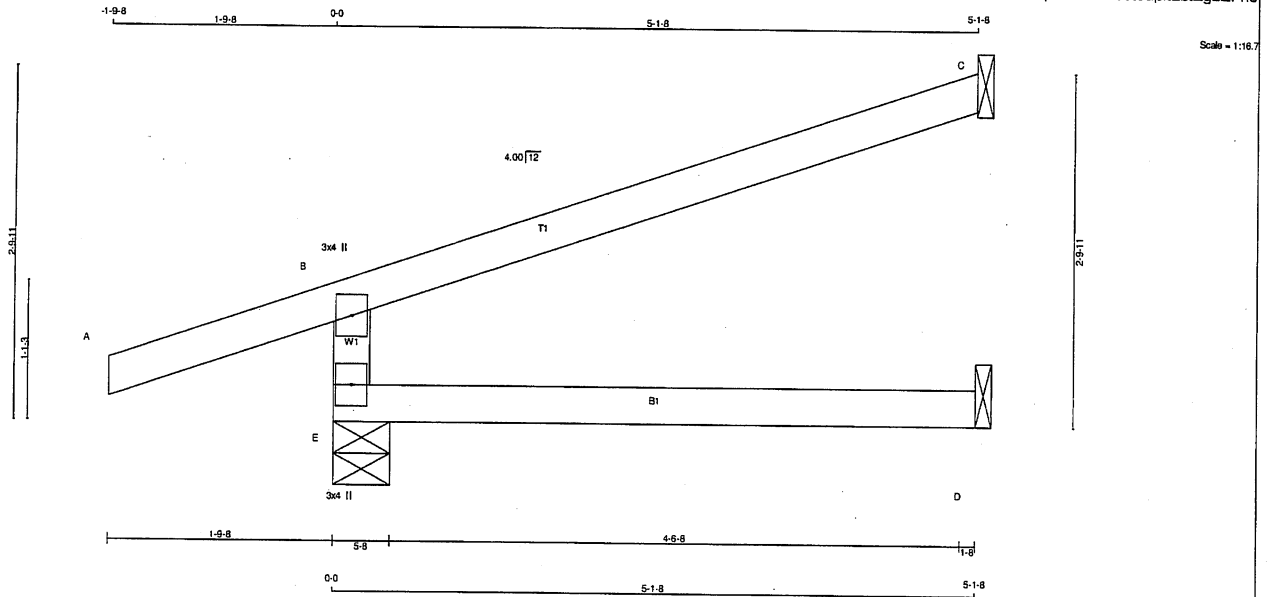

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	DOWN	GROSS REACTION	BRG	BRG
E	518	0	518	0	5-8
C	176	0	176	0	1-8
D	39	0	44	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX /MIN	COMPONENT REACTIONS	DEAD	SOIL
E	363	258 / 0	0 / 0	0 / 0	105 / 0
C	121	98 / 0	0 / 0	0 / 0	23 / 0
D	31	0 / 0	0 / 0	0 / 0	31 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
E-B	-462 / 0	E-B	7.81
A-B	0 / 27	A-B	10.00
B-C	-19 / 0	B-C	6.25
E-D	0 / 0	E-D	10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 4 X 15 = 60 lb [M]

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.41/1.00 (B-C:1), BC=0.10/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SSI=0.22/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.18 (E) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)



Structural component only
DWG# T-2115245

JOB NAME 410918	TRUSS NAME J5	QUANTITY 6	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri May 21 15:05:58 2021 Page 1
ID:GzzEEXDtfkQt_BH_M?wlmisz?k45-DxiB?fb8fLmMnNkyX?kGCTQ00zdqL3r6?LQ56zEFhd

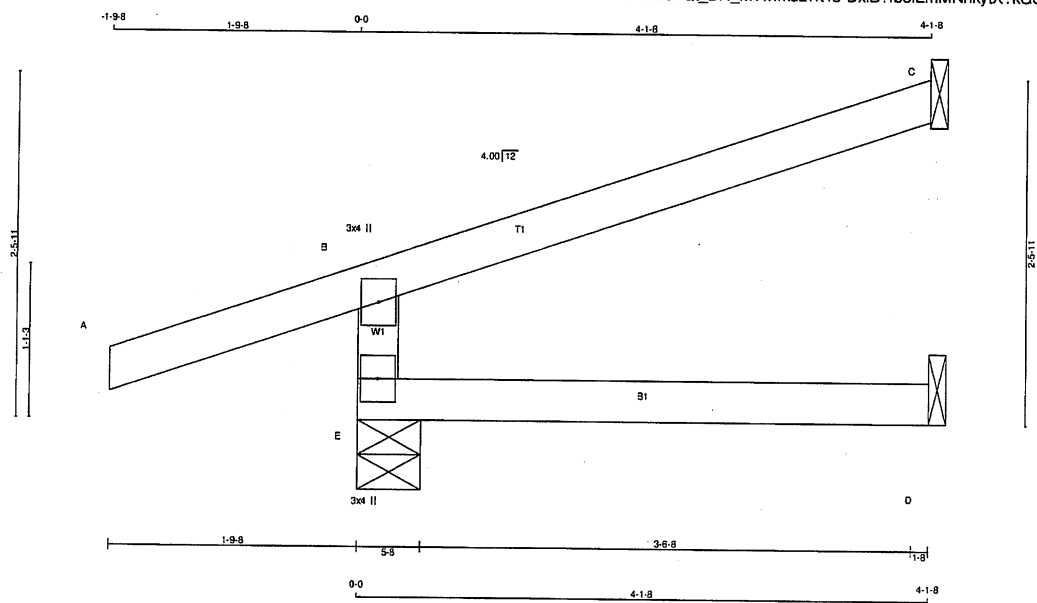

TOTAL WEIGHT = 6 X 13 = 78 lb [M]

LUMBER

N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

NOTES: (1) 1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
E	449	449	5-8	5-8
C	142	142	1-8	1-8
D	32	36	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	314	226 / 0	0 / 0	0 / 0	0 / 0	88 / 0	0 / 0
C	98	79 / 0	0 / 0	0 / 0	0 / 0	19 / 0	0 / 0
D	26	0 / 0	0 / 0	0 / 0	0 / 0	26 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

MEMB.	CHORDS		FACTORED		WEBS	
	MAX. FACTORED	FORCE	VERT. LOAD	LC1 MAX	MAX. UNBRACED	MEMB. FORCE
FR-TO		(LBS)		(PLF)	CSI (LC)	LENGTH FR-TO
E-B	-405 / 0		0.0	0.0	0.06 (4)	7.81
A-B	0 / 27		-91.8	-91.8	0.23 (5)	10.00
B-C	-15 / 0		-91.8	-91.8	0.27 (1)	6.25
E-D	0 / 0		-18.5	-18.5	0.07 (4)	10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.27/1.00 (B-C:1), BC=0.07/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.16 (E) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)

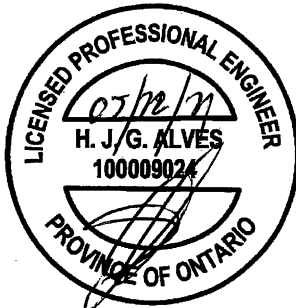

Structural component only
DWG# T-2115246

JOB NAME 410914	TRUSS NAME J6W	QUANTITY 5	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri May 21 13:22:08 2021 Page 1
ID:GzzEEXDtKt BH_M?wlmSz?k45-dOF_SOBHqAsJyMTbv7EnmQSmRfCY8h2rWkDmRDzEHCz

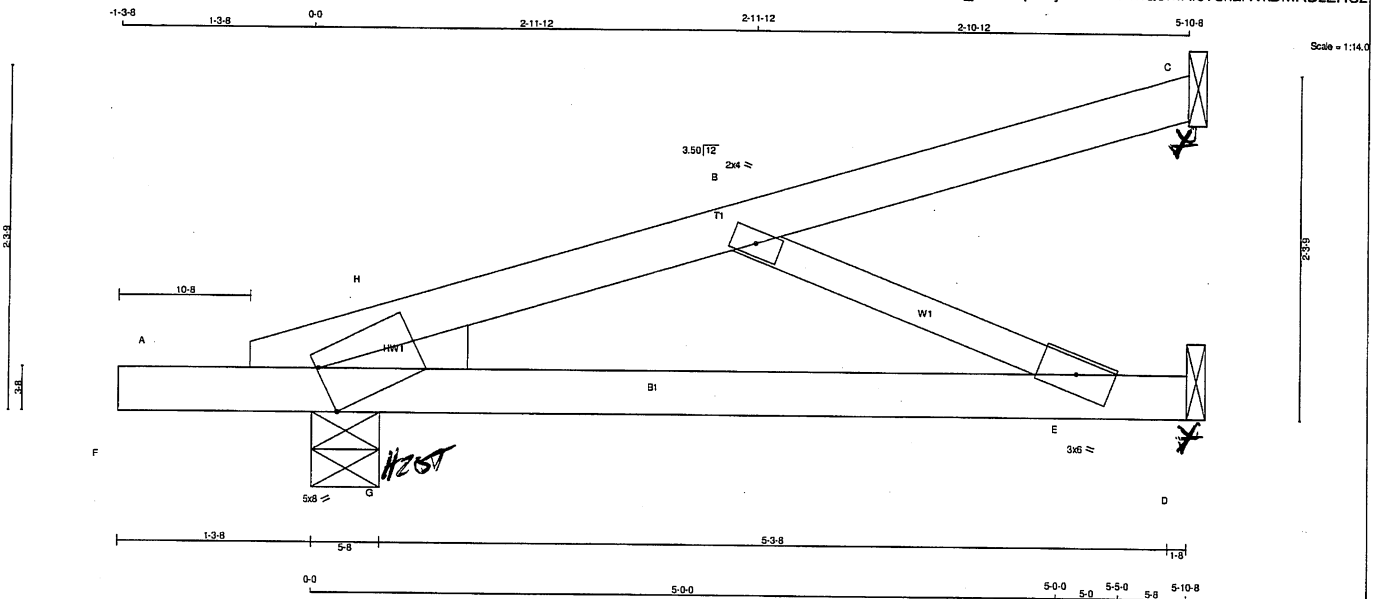

TOTAL WEIGHT = 5 X 19 = 95 lb [MIF]

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	SPF	SPF	SPF
A - C	2x4	DRY	No.2				
F - D	2x4	DRY	No.2				
ALL WEBS	2x3	DRY	No.2				
DRY: SEASONED LUMBER.							

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
A					
B	TBMH1-d	MT20	5.0	8.0	Edge 0.25
C	TMW+w	MT20	2.0	4.0	
D	BMW+w	MT20	3.0	6.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES: (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

UNFACTORED REACTIONS							
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	HEEL
A	389	0	389	120	-209	5-8	2x4 L
C	99	0	99	0	-57	1-8	
D	279	0	279	0	-236	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D
PROVIDE ANCHORAGE AT BEARING JOINT A FOR 209 LBS FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 236 LBS FACTORED UPLIFT
PROVIDE FOR 120 LBS FACTORED HORIZONTAL REACTION AT JOINT A

UNFACTORED REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
A	276	176/0	0/0	0/0	0/-214	100/0	0/0
C	68	58/0	0/0	0/0	0/-47	10/0	0/0
D	200	118/0	0/0	0/0	0/-221	82/0	0/0

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-H	-564 / 272	-91.8 -91.8	0.25 (5)	B-E	-570 / 379	0.11 (1)	
H-B	-490 / 246	-91.8 -91.8	0.25 (5)	G-H	-115 / 91	0.00 (1)	
B-C	-20 / 0	-91.8 -91.8	0.11 (1)				
F-A	0 / 0	-33.5 -33.5	0.00 (12)				
A-G	-337 / 506	-18.5 -18.5	0.11 (1)				
G-E	-337 / 506	-18.5 -18.5	0.36 (1)				
E-D	0 / 0	-18.5 -18.5	0.27 (1)				

WIND LOAD APPLIED IS DERIVED FROM REFERENCE VELOCITY PRESSURE OF (9.2) PSF AT (15-0-0) FT-IN-SX REFERENCE HEIGHT ABOVE GRADE AND USING EXTERNAL PEAK COEFFICIENTS, C_pC_q, BASED ON THE (MAIN WIND FORCE RESISTING SYSTEM) INTERNAL WIND PRESSURE IS BASED ON DESIGN (CATEGORY 2), BUILDING MAY BE LOCATED ON [OPEN TERRAIN], AND TRUSS IS DESIGNED TO BE LOCATED AT LEAST (0-0) FT-IN-SX AWAY FROM EAVE. TRUSS UPLIFT IS BASED ON TOP AND BOTTOM CHORD DEAD LOADS OF 6.0 PSF AND 7.4 PSF RESPECTIVELY.

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL =	25.6 PSF
DL =	6.0 PSF
BOT CH. LL =	0.0 PSF
DL =	7.4 PSF
TOTAL LOAD =	39.0 PSF

SPACING = 24.0 IN. C/C
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.23")
CALCULATED VERT. DEFL. (LL) = L/681 (0.12")
ALLOWABLE DEFL. (TL) = L/360 (0.23")
CALCULATED VERT. DEFL. (TL) = L/535 (0.15")

CANTILEVER DEFLECTION:
ALLOWABLE DEFL. (LL) = L/120 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/120 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.25/1.00 (A-H-5), BC=0.36/1.00 (E-G-1), WB=0.11/1.00 (B-E-1), SS=0.22/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP (DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.47 (B) (INPUT = 0.90)
JSI METAL = 0.29 (B) (INPUT = 1.00)




Structural component only
DWG# T-2115212

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410918	J30	6	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri Jun 4 09:44:41 2021 Page 1
ID:GzzEEEDtfkQt_BH_M?wlmisz?k45-TX90iOuzw7wO6vpVx7hunGY5pRUs0AuzSGGbtzh9j4c

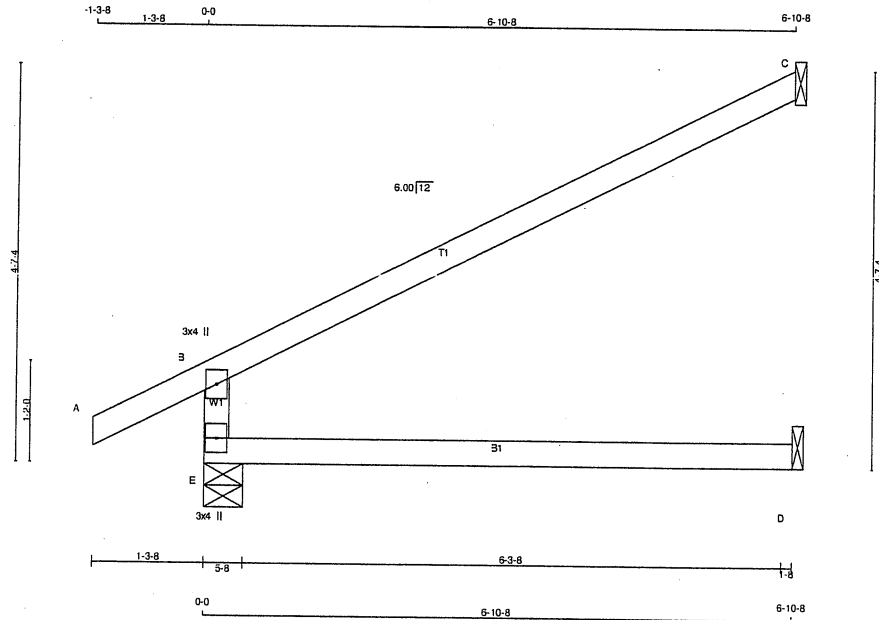

Scale = 1:25.5

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
E	594	0	594	0	0	5-8	5-8	5-8	5-8
C	237	0	237	0	0	1-8	1-8	1-8	1-8
D	52	0	58	0	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C , D

UNFACTORED REACTIONS		1ST LCASE		MAX./MIN. COMPONENT REACTIONS		SNOW		LIVE		PERM.LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	JT	COMBINED
E	417	289 / 0	0 / 0	0 / 0	0 / 0	128 / 0	0 / 0	E	417	289 / 0	0 / 0	0 / 0	0 / 0	128 / 0	0 / 0	E	417
C	163	132 / 0	0 / 0	0 / 0	0 / 0	31 / 0	0 / 0	C	163	132 / 0	0 / 0	0 / 0	0 / 0	31 / 0	0 / 0	C	163
D	42	0 / 0	0 / 0	0 / 0	0 / 0	42 / 0	0 / 0	D	42	0 / 0	0 / 0	0 / 0	0 / 0	42 / 0	0 / 0	D	42

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT.	LOAD (PLF)	LC1 MAX	MAX. (LC)	MEMB.	FORCE (LBS)	MAX. (LC)	CS1 (LC)
FR-TO		FROM	TO			FR-TO		FROM	TO
E-B	-519 / 0	0.0	0.0	0.16 (4)	7.81	E-B	-519 / 0	0.0	0.0
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	A-B	0 / 28	-91.8	-91.8
B-C	-35 / 0	-91.8	-91.8	0.57 (1)	6.25	B-C	-35 / 0	-91.8	-91.8
E-D	0 / 0	-18.5	-18.5	0.19 (4)	10.00	E-D	0 / 0	-18.5	-18.5

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.23")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.23")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.06")

CSI: TC=0.57/1.00 (B-C:1) , BC=0.19/1.00 (D-E:4) , WB=0.00/1.00 (n/a:0) , SSI=0.28/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.21 (E) (INPUT = 0.90)
JSI METAL= 0.14 (B) (INPUT = 1.00)




Structural component only
DWG# T-2117650

Structural component only
DWG# T-2117651

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410918	J33	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri Jun 4 09:44:43 2021 Page 1
ID:GzzEEXDtKQt_BH_M?wlmz?k45-PwH873vERkA6MDzu3YjMsheRqF9JU4OGwalixZz9j4o

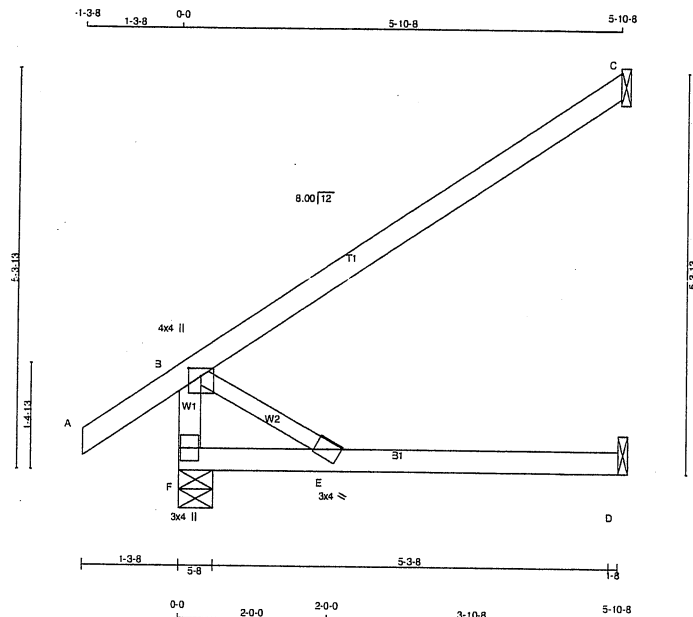

Scale = 1/20.2

<u>LUMBER</u>					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR.
F - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS		2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER					

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
F	450	450	5-8	5-8
C	270	270	1-8	1-8
D	54	61	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
F	316	221 / 0	0 / 0	95 / 0	0 / 0
C	186	150 / 0	0 / 0	35 / 0	0 / 0
D	43	0 / 0	0 / 0	43 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO								
F-B	-395 / 0	0.0	0.0	0.04 (1)	7.81	0 / 0	0.00 (1)	
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00			
B-C	0 / 0	-91.8	-91.8	0.54 (1)	10.00			
F-E	0 / 0	-18.5	-18.5	0.17 (4)	10.00			
E-D	0 / 0	-18.5	-18.5	0.19 (4)	10.00			

TOTAL WEIGHT = 2 X 20 = 39 lb [M]

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL(LL) = L/360 (0.20")
CALCULATED VERT. DEFL(LL) = L/999 (0.00")
ALLOWABLE DEFL(TL) = L/360 (0.20")
CALCULATED VERT. DEFL(TL) = L/999 (0.05")

CSI: TC=0.54/1.00 (B-C:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SSI=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.26 (B) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)



Structural component only
DWG# T-2117652

JOB NAME 410914	TRUSS NAME C1	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 13:22:01 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wlmz?k45-K2KL_?6uU0zJcHQF?9b8_yburHC?Y0pv80ui7zEHD4

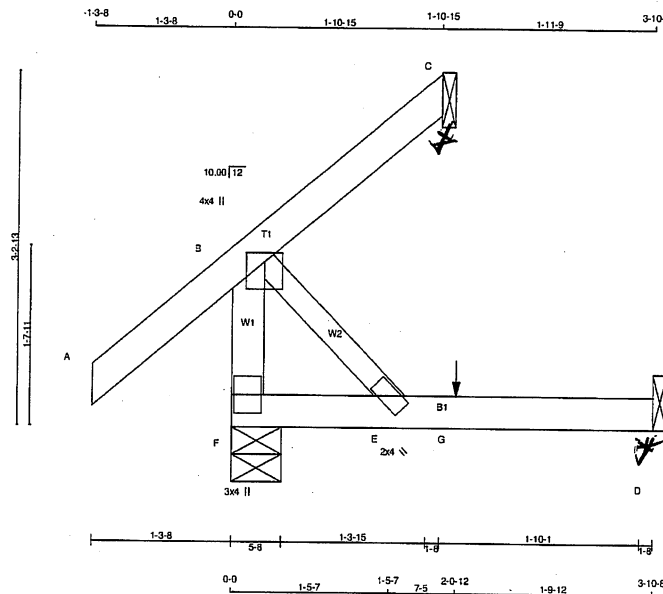

Scale = 1:19.2

TOTAL WEIGHT = 12 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DESCR.
SPF
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
F	297	0	297	0	0	5-8	5-8	
C	42	0	42	0	-36	1-8	1-8	
D	36	0	40	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
F	208	145 / 0	0 / 0	0 / 0	0 / 0	63 / 0	0 / 0
C	29	23 / -26	0 / 0	0 / 0	0 / 0	5 / 0	0 / 0
D	29	0 / 0	0 / 0	0 / 0	0 / 0	29 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		FACTORED		WEBS		FACTORED	
	MAX. FORCE (LBS)	VERT. LOAD (LBS)	LC1 (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH FR-TO	MEMB. FORCE (LBS)	MAX. CSI (LC)	
FR-TO								
F-B	-261 / 0	0.0	0.0	0.03 (1)	7.81	B-E	0 / 0	0.00 (1)
A-B	0 / 41	-91.8	-91.8	0.15 (5)	10.00			
B-C	-29 / 0	-91.8	-91.8	0.14 (5)	6.25			
F-E	0 / 0	-18.5	-18.5	0.08 (4)	10.00			
E-G	0 / 0	-18.5	-18.5	0.08 (4)	10.00			
G-D	0 / 0	-18.5	-18.5	0.08 (4)	10.00			

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	2-0-12	1	1	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
BOT CH. LL = 6.0 PSF
LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.15/1.00 (A-B-5), BC=0.08/1.00 (D-E-4), WB=0.00/1.00 (B-E-1), SS=0.09/1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.19 (B) (INPUT = 0.90)
JSI METAL = 0.05 (B) (INPUT = 1.00)



Structural component only
DWG# T-2115204

JOB NAME 410914	TRUSS NAME C2	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 13:22:02 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wlmisz?k45-oEujCL7WEK5AER?RZs7NX9CnxFeNk?Gy8omSEZzEHD3

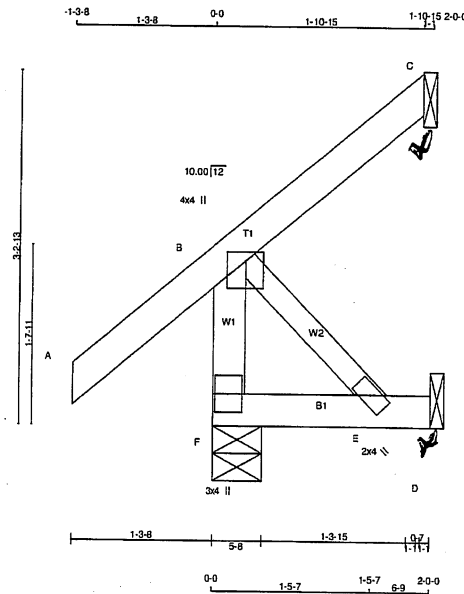

Scale = 1:19.2

TOTAL WEIGHT = 10 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - B	2x4	DRY	No.2	
A - C	2x4	DRY	No.2	
F - D	2x4	DRY	No.2	
ALL WEBS	2x3	DRY	No.2	
DRY: SEASONED LUMBER.				

DESCR.
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
F	279	0	279	0
C	42	0	42	0
D	18	0	21	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
F	194	145 / 0	0 / 0	0 / 0	0 / 0	49 / 0
C	29	23 / -26	0 / 0	0 / 0	0 / 0	5 / 0
D	15	0 / 0	0 / 0	0 / 0	0 / 0	15 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	UNBRAC LENGTH FR-TO	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO										
F-B		-261 / 0	0.0	0.0	0.03 (1)	7.81	B-E		0 / 0	0.00 (1)
A-B		0 / 41	-91.8	-91.8	0.13 (1)	10.00				
B-C		-29 / 0	-91.8	-91.8	0.12 (1)	6.25				
F-E		0 / 0	-18.5	-18.5	0.02 (4)	10.00				
E-D		0 / 0	-18.5	-18.5	0.02 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL (LL) = L/360 (0.19")
CALCULATED VERT. DEFL (LL) = L/999 (0.00")
ALLOWABLE DEFL (TL) = L/360 (0.19")
CALCULATED VERT. DEFL (TL) = L/999 (0.00")

CSI: TC=0.13/1.00 (A-B:1), BC=0.02/1.00 (E-F:4), WB=0.00/1.00 (B-E:1), SSI=0.08/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.19 (B) (INPUT = 0.90)
JSI METAL = 0.05 (B) (INPUT = 1.00)




Structural component only
DWG# T-2115205

JOB NAME 410918	TRUSS NAME C30	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri Jun 4 09:44:38 2021 Page 1
ID:GzzEEXDtKQL_BH_M?wlmisz?k45-2yTF3Mr5dCYpFS4wG?7B9dwnES8pp8XmI2xGMz9j4

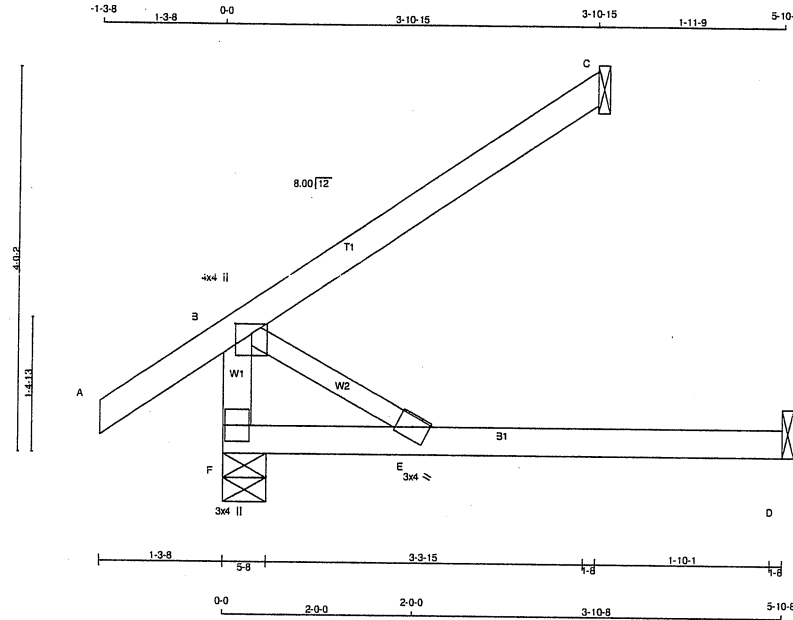

TOTAL WEIGHT = 17 lb [M]

LUMBER				DESCR.
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	
F - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMW+w	MT20	3.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
F	360	0	360	0	5-8	5-8
C	179	0	179	0	1-8	1-8
D	54	0	61	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS				WIND	DEAD	SOIL
		COMBINED	SNOW	LIVE	PERM.LIVE			
F	254	170 / 0	0 / 0	0 / 0	0 / 0	83 / 0	0 / 0	0 / 0
C	124	100 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0	0 / 0
D	43	0 / 0	0 / 0	0 / 0	0 / 0	43 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		WEBS		FACTORED	
	MAX.	FACTORED	VERT. LOAD	LC1 MAX	MAX.	MEMB.	FORCE	MAX
FR-TO		(LBS)	(PLF)	CSI (LC)	UNBRAC LENGTH	FR-TO	(LBS)	CSI (LC)
F-B	-305 / 0	0.0	0.0	0.03 (1)	7.81	B-E	0 / 0	0.00 (1)
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00			
B-C	0 / 0	-91.8	-91.8	0.24 (1)	10.00			
F-E	0 / 0	-18.5	-18.5	0.17 (4)	10.00			
E-D	0 / 0	-18.5	-18.5	0.19 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.24/1.00 (B-C:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.20 (B) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2117646

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri Jun 4 09:44:39 2021 Page 1
ID:GzzEEXDtfkQt_BH_M?wlmisz?k45-X91dHisjOWggctcf7qjeQhrTsleoNYGOH?ynUooz9i4s

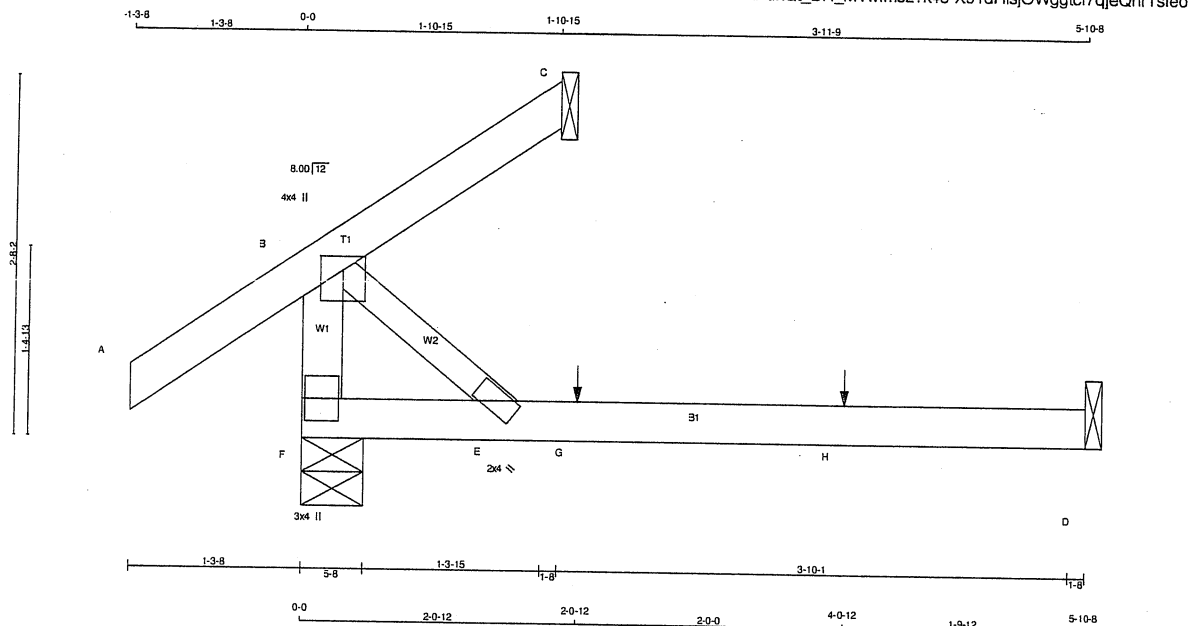

TOTAL WEIGHT = 14 lb

N. L. G. A. RULES		LUMBER	
CHORDS	SIZE		
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2

ALL WEBS 2x3 DRY
 DRY: SEASONED LUMBER.

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
E	BMW+w	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

1) Lateral braces to be a minimum of 2x4 SPF #2

	FACTORED		MAXIMUM FACTORED		INPUT	REQRD
	VERT	HORZ	DOWN	HORZ	BRG	BRG
JT	313	0	313	0	0	5-8
F	42	0	42	0	0	1-8
C	54	0	61	0	0	1-8
D						

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	222	144 / 0	0 / 0	0 / 0	0 / 0	77 / 0	0 / 0
C	29	24 / 0	0 / 0	0 / 0	0 / 0	6 / 0	0 / 0
D	43	0 / 0	0 / 0	0 / 0	0 / 0	43 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F. C

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

TOTAL LOAD CASES: (4)

C H O R D S				W E B S			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
F-B	-259 / 0	0.0 0.0	0.03 (1)	7.81	B-E	0 / 0	0.00 (1)
A-B	0 / 35	-91.8 -91.8	0.13 (1)	10.00			
B-C	-25 / 0	-91.8 -91.8	0.12 (1)	6.25			
F-E	0 / 0	-18.5 -18.5	0.14 (4)	10.00			
E-G	0 / 0	-18.5 -18.5	0.19 (4)	10.00			
G-H	0 / 0	-18.5 -18.5	0.19 (4)	10.00			
H-D	0 / 0	-18.5 -18.5	0.19 (4)	10.00			

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	2-0-12	1	1	---	BACK	VERT	TOTAL	---	C1
H	4-0-12	1	1	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD		=	39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.05")

CSI: TC=0.13/1.00 (A-B:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SSI=0.09/1.00 (B-C:1)

DOL LUMBER=0.98 NAIL=0.98 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	650	371	1747	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.90)

JSI METAL= 0.05 (B) (INPUT = 1.00)




Structural component only
DWG# T-2117647

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri Jun 4 09:44:40 2021 Page 1
ID:GzzEEXDtfkQt_BH_M?wlmsz?k45-?Lb?U2tL9poXVIEJNQ9fE20?H2AEHieqEcX2LFz9j4

Scale = 1:23.2

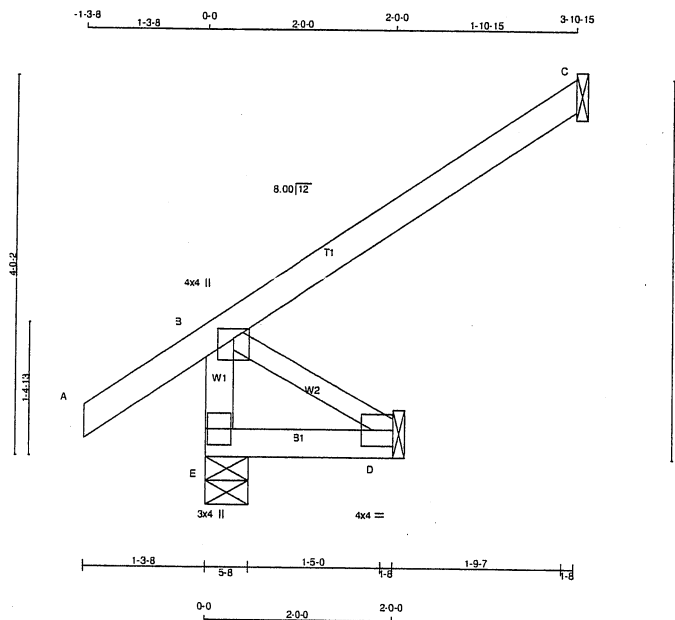

TOTAL WEIGHT = 12 lb

N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
D	BMW1-t	MT20	4.0	4.0	2.00	Edge
E	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

1) Lateral braces to be a minimum of 2x4 SPF #2

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT IN-SX	IN-SX
E	323	0	323	0	0	5-8
C	179	0	179	0	0	1-8
D	18	0	20	0	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C . D

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	224	170 / 0	0 / 0	0 / 0	0 / 0	54 / 0	0 / 0
C	124	100 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0
D	14	0 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

TOTAL LOAD CASES: (5)

CHORDS					WEBS				
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FORCE (LBS)	FACTORED MAX CSI (LC)	
FR-TO		FROM	TO			FR-TO			
E-B	-305 / 0	0.0	0.0	0.03 (1)	7.81				
A-B	0 / 35	-91.8	-91.8	0.13 (5)	10.00	B-D	0 / 0	0.00 (1)	
B-C	0 / 0	-91.8	-91.8	0.24 (1)	10.00				
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.00")

CSI: TC=0.24/1.00 (B-C:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (B-D:1), SSI=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES						
PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	650	371	1747	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.20 (B) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2117648

JOB NAME 410918	TRUSS NAME C33	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri Jun 4 09:44:41 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wmsz?k45-TX9OI0uzw7wO6vpVx7hunGYCqRWT0AuzSGbthz9j4c

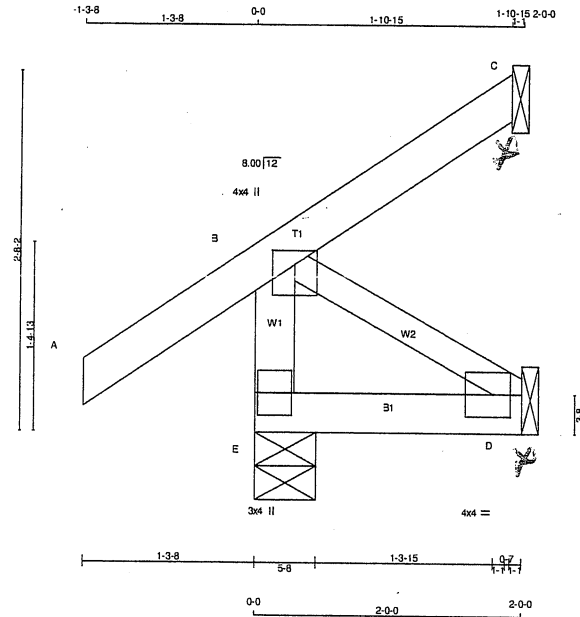

Scale = 1:16.4

TOTAL WEIGHT = 10 lb [M]

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DESCR.
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
E	276	0	276	0
C	42	0	42	0
D	18	0	20	0

SEE MITTEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

	1ST LCASE	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
JT	COMBINED						
E	192	144 / 0	0 / 0	0 / 0	0 / 0	48 / 0	0 / 0
C	29	24 / -25	0 / 0	0 / 0	0 / 0	6 / 0	0 / 0
D	14	0 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
E-B	-259 / 0	0.0	0.0 0.03 (1)	7.81	B-D	0 / 0	0.00 (1)
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00			
B-C	-25 / 0	-91.8	-91.8 0.12 (1)	6.25			
E-D	0 / 0	-18.5	-18.5 0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL)= L/360 (0.19")

CALCULATED VERT. DEFL.(TL)= L/ 999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (B-D:1), SSI=0.09/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	650	371
	1747	788
	1987	1873


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)



Structural component only
DWG# T-2117649



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering *em and General Safety notes.

T-1900213

Feb 09, 2018

TOE-NAIL CAPACITY DETAILS

LATERAL AND WITHDRAWAL RESISTANCE OF BEARING ANCHORAGE BY TOE-NAILS

			SPF	D. FIR	SPF	D. FIR
COMMON WIRE	3.00	0.144	122	139	30	42
	3.25	0.144	127	144	32	45
	3.50	0.160	152	173	38	52
COMMON SPIRAL	3.00	0.122	96	108	26	36
	3.25	0.122	97	108	28	40
	3.50	0.152	142	161	36	50
3.25" Gun nail	3.25	0.120	94	105	28	39

Note: If using truss with D. Fir lumber and SPF bearing plate, use tabulated SPF values in table.

Nail type:	Common wire	Common spiral	Common wire	Common spiral	Gun Nail
Diameter (in.)	0.160	0.152	0.144	0.122	0.120
Length (in.)	3.50	3.50	3.00	3.00	3.25
2x4 SPF	2	2	3	3	3
2x6 SPF	4	4	4	5	5
2x4 D. FIR	2	2	2	2	2
2x6 D. FIR	3	3	3	4	4

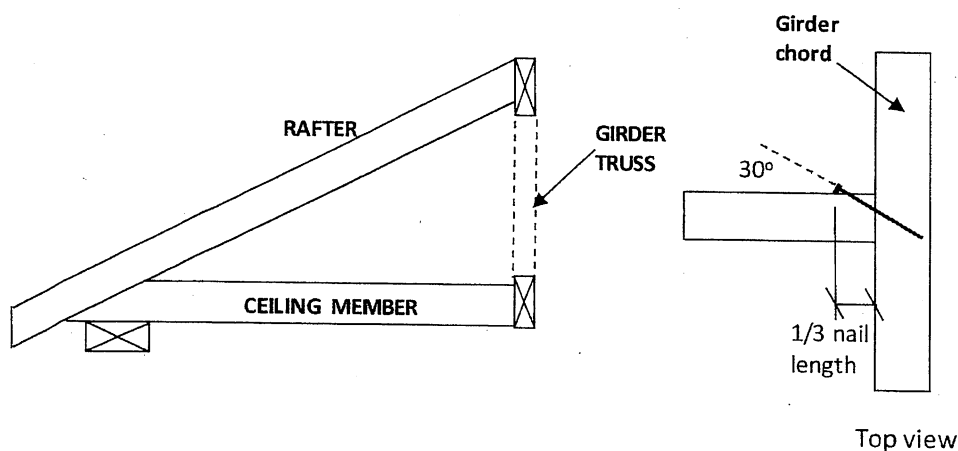


Figure 1: Toe-Nailing Rafter / Ceiling Member to Girder Truss


PEO
Certificate No. 10889485



December 21, 2020

TOE-NAIL CAPACITY DETAILS

Figure 2: Toe-Nail Anchorage to Bearing Plate for Uplift

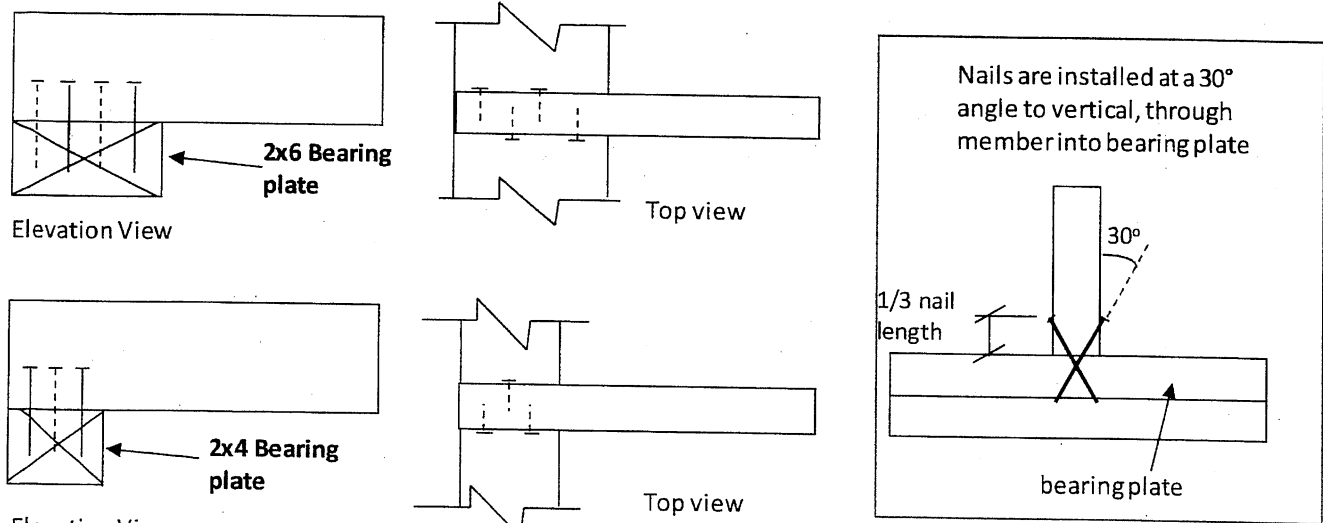

NOTES:

1. Rafter and ceiling members may be connected to top and bottom chords of girder truss by toe-nailing the members into the girder chords (see fig. 1), provided the factored vertical reactions of the supported members do not exceed the lateral resistance of the toe-nails. Mechanical connectors (hangers) are required if factored vertical reactions exceed the toe-nail capacity, or if the connection must resist horizontal loads (loads perpendicular to the face of girder or rafter).
2. Trusses, rafters or ceiling members may be anchored to the bearing plate with toe-nails (see fig. 2), provided that the factored uplift reactions due to **wind or earthquake loads** do not exceed the **withdrawal resistance of the toe-nails**. Mechanical anchors (tie-downs) are required for reactions that exceed the toe-nail withdrawal capacity. Toe-nail anchorage to bearing plates is **NOT** permitted if uplift reactions are generated from gravity loads (snow, floor live, dead).
3. Tabulated toe-nail resistances on page 1 are for **one** toe-nail. Multiply unit values by the number of nails used in the connection. Maximum number of nails in a connection shall not exceed the tabulated limits shown on page 1 for a given lumber size /species.
4. Nail values are based on specific gravity of $G = 0.42$ (SPF) and $G = 0.49$ (D. Fir).
5. Toe-nails shall be driven at approximately $1/3$ the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member.
6. For wind / earthquake loads, tabulated lateral resistances may be multiplied by 1.15 (K_D factor). No increases are permitted for tabulated withdrawal resistances.
7. Lumber must be dry ($< 19\%$ moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-19, Clause 12.9.

PEO
Certificate No. 10889485



LUL/LUS/LJS/HUS/HHUS/HGUS

SIMPSON
Strong-Tie

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of a) easier installation, b) higher capacities, c) lower installed cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 217–218.


Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 18–20.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1 1/2" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on pp. 105–107.



Double-Shear Nailing Top View






Double-Shear Nailing Side View; Do not bend tab




Dome Double-Shear Nailing Side View (available on some models)


Typical HUS26 Installation with Reduced Heel Height
(Truss Designer to provide fastener quantity for connecting multiple members together)

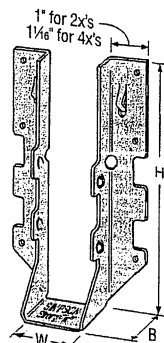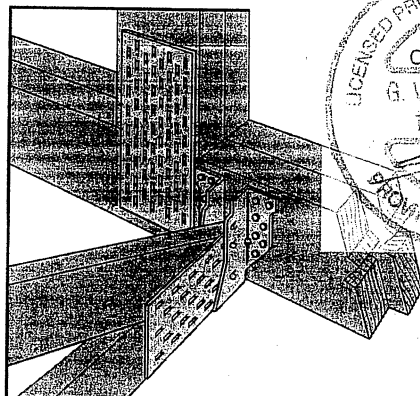


LUS28




LU26L

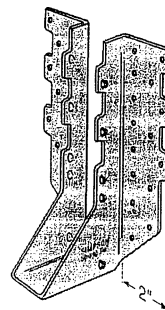


HUS210
(HUS26, HUS28, and HHUS similar)

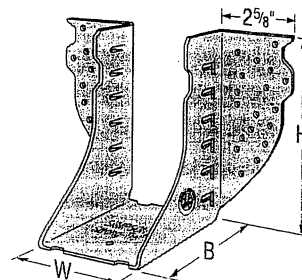

HGUS28-2

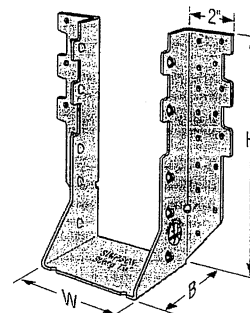

HHUS210-2



LJS26DS

TECHNICAL BULLETIN

LUS - Double Shear Joist Hangers

SIMPSON
Strong-Tie

All LUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections.

Material: 18 gauge

Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners.
- Nails: 16d = 0.162" dia. x 3 1/2" long common wire, 10d = 0.148" x 3" long common wire.
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads.
- Not designed for welded or nailer applications.

Options:

- These hangers cannot be modified

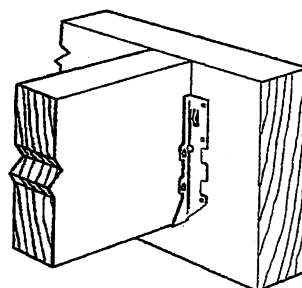


Typical LUS Installation

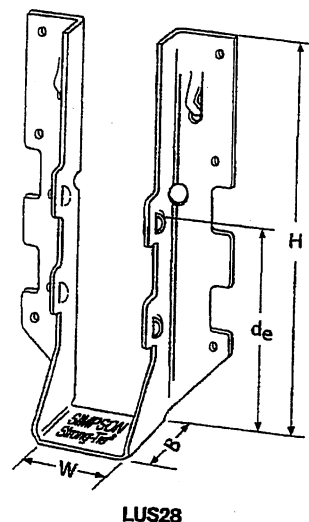


Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
		W	H	B	d _o ¹	Face	Joist	D-Fir-L		S-P-F	
								Uplift (K _o =1.15)	Normal (K _o =1.00)	Uplift (K _o =1.15)	Normal (K _o =1.00)
LUS24	18	1 1/16	3 1/8	1 1/4	1 15/16	(4) 10d	(2) 10d	710	1630	645	1155
LUS24-2	18	3 1/8	3 1/8	2	1 15/16	(4) 16d	(2) 16d	835	2020	590	1435
LUS26	18	1 1/16	4 3/8	1 3/4	3 3/8	(4) 10d	(4) 10d	1420	2170	1290	1630
LUS26-2	18	3 1/8	4 7/8	2	4	(4) 16d	(4) 16d	1720	2595	1545	1920
LUS26-3	18	4 3/8	4 3/8	2	3 3/4	(4) 16d	(4) 16d	1720	2595	1545	2340
LUS28	18	1 1/16	6 3/8	1 3/4	3 3/8	(6) 10d	(6) 10d	1420	2520	1290	1790
LUS28-2	18	3 1/8	7	2	4	(6) 16d	(4) 16d	1720	3325	1545	2575
LUS28-3	18	4 3/8	6 1/4	2	3 3/4	(6) 16d	(4) 16d	1720	3325	1545	2375
LUS210	18	1 1/16	7 13/16	1 3/4	3 3/8	(8) 10d	(4) 10d	1420	2785	1290	2210
LUS210-2	18	3 1/8	9	2	6	(8) 16d	(6) 16d	2580	4500	2320	3195
LUS210-3	18	4 3/8	8 3/8	2	5 1/4	(8) 16d	(6) 16d	2580	3345	2320	2375

1. d_o is the distance from the seat of the hanger to the highest joist nail.




Dome Double Shear Nailing prevents tabs breaking off (available on some models).

U.S. Patent 5,603,580



Double Shear Nailing Top View.

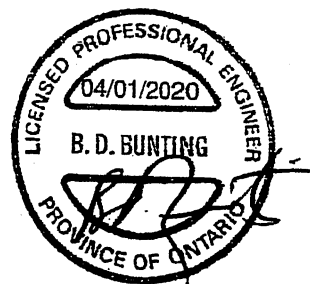

LIMIT STATES DESIGN

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPECUS20 3/20 exp. 6/22

(800) 999-5099
strongtie.com

TECHNICAL BULLETIN

HUS/LJS – Double Shear Joist Hangers

SIMPSON
Strong-Tie

All hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

Material: See table

Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners
- Nails: 16d = 0.162" dia. x 3½" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

Options:


- See current catalogue for options




LJS26DS




HUS210
(HUS26, HUS28, similar)



Typical LJS26DS
Installation




Typical HUS
Installation

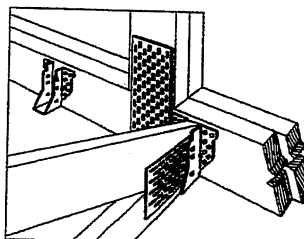

Typical HUS Installation
(Truss Designer to provide fastener quantity for connecting multiple members together)


Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
		W	H	B	d _s ¹	Face	Joist	D.Fir-L		S-P-F	
								Uplift (K _p =1.15)	Normal (K _p =1.00)	Uplift (K _p =1.15)	Normal (K _p =1.00)
LJS26DS	18	1⅞	5	3½	4⅝	(16) 16d	(6) 16d	2055	4265	1460	4115
HUS26	16	1⅞	5⅝	3	3⅞	(14) 16d	(6) 16d	2705	4940	2065	3875
HUS28	16	1⅞	7⅝	3	6⅝	(22) 16d	(8) 16d	3605	5365	2675	4345
HUS210	16	1⅞	9⅝	3	7⅝	(30) 16d	(10) 16d	4505	5795	4010	4740
HUS1.81/10	16	1⅞	9	3	8	(30) 16d	(10) 16d	4505	6450	4010	5200

1. d_s is the distance from the seat of the hanger to the highest joist nail.




Dome Double Shear Nailing prevents tabs breaking off (available on some models).

U.S. Patent 5,603,580



Double Shear Nailing Side View. Do not bend tab back.



Double Shear Nailing Top View.



**LIMIT
STATES
DESIGN**

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPECHUS20 3/20 exp. 6/22

(800) 999-5099
strongtie.com

TECHNICAL BULLETIN

HGUS – Double Shear Joist Hangers

SIMPSON
Strong-Tie

All HGUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

Material: 12 gauge

Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%.
No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners
- Nails: 16d = 0.162" dia x 3½" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

Options:


- See current catalogue for options

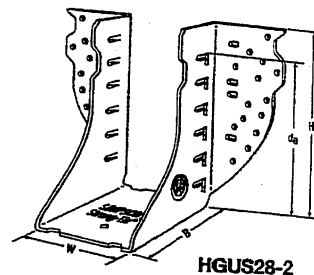

HGUS28-2

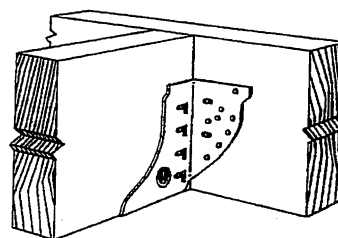


Typical HGUS Installation

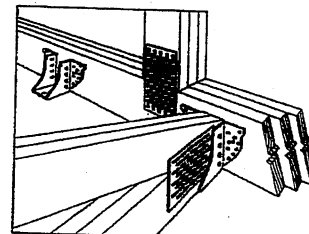

Typical HGUS Installation
(Truss Designer to provide fastener quantity for connecting multiple members together)


Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
		W	H	B	d _g ¹	Face	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _u =1.15)	(K _n =1.00)	(K _u =1.15)	(K _n =1.00)
HGUS26	12	1½	5½	5	4½	(20) 16d	(8) 16d	2685	6625	2685	5700
HGUS26-2	12	3½	5½	4	4½	(20) 16d	(8) 16d	4385	8950	3100	6355
HGUS26-3	12	4½	5½	4	4½	(20) 16d	(8) 16d	4385	8950	3100	6355
HGUS26-4	12	6½	5½	4	4½	(20) 16d	(8) 16d	4385	8950	3100	6355
HGUS28	12	1½	7½	5	6½	(36) 16d	(12) 16d	3310	7675	3100	6900
HGUS28-2	12	3½	7½	4	6½	(36) 16d	(12) 16d	6070	12980	4310	9215
HGUS28-3	12	4½	7½	4	6½	(36) 16d	(12) 16d	6070	12980	4310	9215
HGUS28-4	12	6½	7½	4	6½	(36) 16d	(12) 16d	6070	12980	4310	9215
HGUS210	12	1½	9½	5	7½	(46) 16d	(16) 16d	3535	11070	2510	8090
HGUS210-2	12	3½	9½	4	8½	(46) 16d	(16) 16d	6840	14015	4855	10270
HGUS210-3	12	4½	9½	4	8½	(46) 16d	(16) 16d	6840	14645	4855	10400
HGUS210-4	12	6½	9½	4	8½	(46) 16d	(16) 16d	6840	14645	4855	10400
HGUS212-4	12	6½	10½	4	10½	(56) 16d	(20) 16d	7640	14995	5425	10645
HGUS214-4	12	6½	12½	4	11½	(66) 16d	(22) 16d	10130	16400	7195	11645

1. d_g is the distance from the seat of the hanger to the highest joist nail.




Dome Double Shear Nailing prevents tabs breaking off (available on some models).


U.S. Patent 5,603,580



Double Shear Nailing Side View. Do not bend tab back.



Double Shear Nailing Top View.

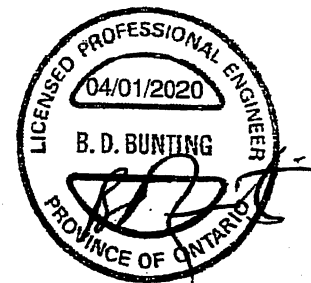

LIMIT STATES DESIGN

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPECHGUS20 3/20 exp. 6/22

(800) 999-5099
strongtie.com

TECHNICAL BULLETIN

HHUS – Double Shear Joist Hangers

SIMPSON
Strong-Tie

All HHUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

Material: 14 gauge

Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners
- Nails: 16d = 0.162" dia. x 3 1/2" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

Options:


- See current catalogue for options

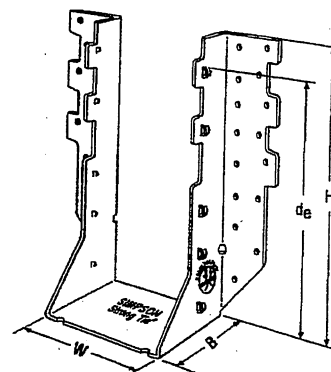

HHUS410

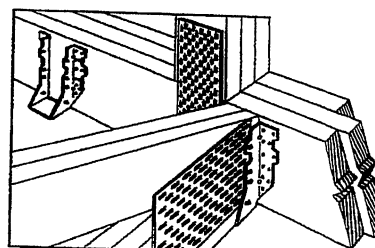


Typical HHUS Installation
(Truss Designer to provide fastener quantity for connecting multiple members together)




Typical HHUS Installation

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
		W	H	B	d _e ¹	Face	Joist	D-Fir-L		S-P-F	
								Uplift (K _u =1.15)	Normal (K _n =1.00)	Uplift (K _u =1.15)	Normal (K _n =1.00)
HHUS26-2	14	3 1/16	5 13/16	3	3 13/16	(14) 16d	(6) 16d	2850	7335	2065	5205
HHUS28-2	14	3 1/16	7 7/32	3	6 5/32	(22) 16d	(8) 16d	3765	8940	2675	6345
HHUS210-2	14	3 1/16	9 3/32	3	8	(30) 16d	(10) 16d	4670	9660	4235	7000
HHUS210-3	14	4 1/16	9	3	7 15/16	(30) 16d	(10) 16d	4670	9670	4235	6865
HHUS210-4	14	6 1/8	8 29/32	3	7 27/32	(30) 16d	(10) 16d	4670	10155	4235	7210
HHUS46	14	3 3/8	5 13/32	3	3 15/16	(14) 16d	(6) 16d	2540	7335	2065	5205
HHUS48	14	3 3/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3765	8940	2675	6345
HHUS410	14	3 3/8	9	3	8	(30) 16d	(10) 16d	4670	9855	4235	7000
HHUS5.50/10	14	5 1/2	9	3	8	(30) 16d	(10) 16d	4670	10155	4235	7210
HHUS7.25/10	14	7 1/4	9	3 3/16	7 29/32	(30) 16d	(10) 16d	4670	10155	3370	7210


1. d_e is the distance from the seat of the hanger to the highest joist nail.




Dome Double Shear Nailing prevents tabs breaking off (available on some models).
U.S. Patent 5,603,580



Double Shear Nailing Side View. Do not bend tab back.



Double Shear Nailing Top View.

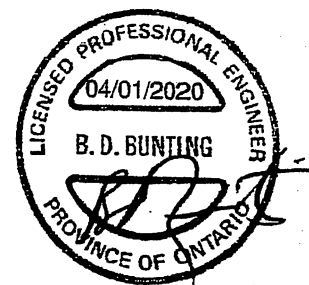

LIMIT
STATES
DESIGN

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.


© 2020 Simpson Strong-Tie Company Inc.

T-SPECHUS20 3/20 exp. 6/22


(800) 999-5099
strongtie.com

H/TSP


Seismic and Hurricane Ties (cont.)




1 H1 Installation




2 H2A Installation




3 TSP Installation




4 H2.5A Installation
(Nails into both top plates)




5 H2.5T Installation
(Nails into both top plates)




6 H2.5T Installation




7 H3 Installation
(Nails into upper top plate)




8 H6 Stud to Top Plate Installation

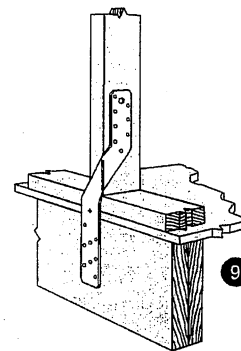


9 H6 Stud to Band Joist Installation

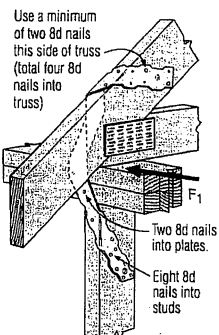


10 H7Z Installation




11 H8 Attaching Rafter to Double Top Plates




12 H8 attaching Stud to Sill
((4) 8d into plate, (5) 8d into stud)




13 H8 attaching I-Joist to Double Top Plates




14 H10A Field-Bent Installation



15 H10S Installation




16 H10S Installation with Stud Offset




17 H10A Installation

H10A optional positive angle nailing connects shear blocking to rafter. Use 8d common nails. Slot allows maximum field-bending up to a pitch of 6/12, use 75% of the table uplift value; bend one time only.




18 H14 Installation to Double Top Plates

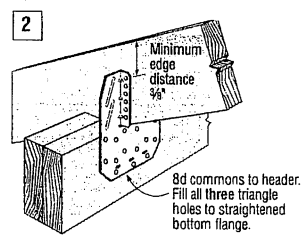

19 H14 Installation to Double 2x Header

Avoid a Misinstallation



Do not make new holes or overdrive nails.

H/TSP

Seismic and Hurricane Ties

Simpson Strong-Tie® hurricane ties provide a positive connection between truss/rafter and the wall of the structure to resist wind and seismic forces. New additions to the line provide even more options.


- H10AR — The heavy-duty design of the H10A available with a 2" wide throat to accommodate rough lumber
- H10A-2 — The H10A design with a 3" throat for double 2x members
- H2ASS, H2.5ASS and H10ASS — Popular ties now available in stainless steel

Material: See table

Finish: Galvanized. H7Z and H11Z — ZMAX® coating. Some models available in stainless steel or ZMAX; see Corrosion Information, pp. 20–24 or visit strongtie.com.

Installation:

- Use all specified fasteners; see General Notes.
- H1 can be installed with flanges facing inward (reverse of H1 installation drawing; number 1).
- H2.5T, H3 and H6 ties are shipped in equal quantities of right and left versions (right versions shown).
- Hurricane ties do not replace solid blocking.
- When installing ties on plated trusses (on the side opposite the truss plate) do not fasten through the truss plate from behind. This can force the truss plate off of the truss and compromise truss performance.
- H10A optional nailing to connect shear blocking, use 8d nails. Slots allow maximum field bending up to a pitch of 6:12; use H10A sloped loads for field bent installation.

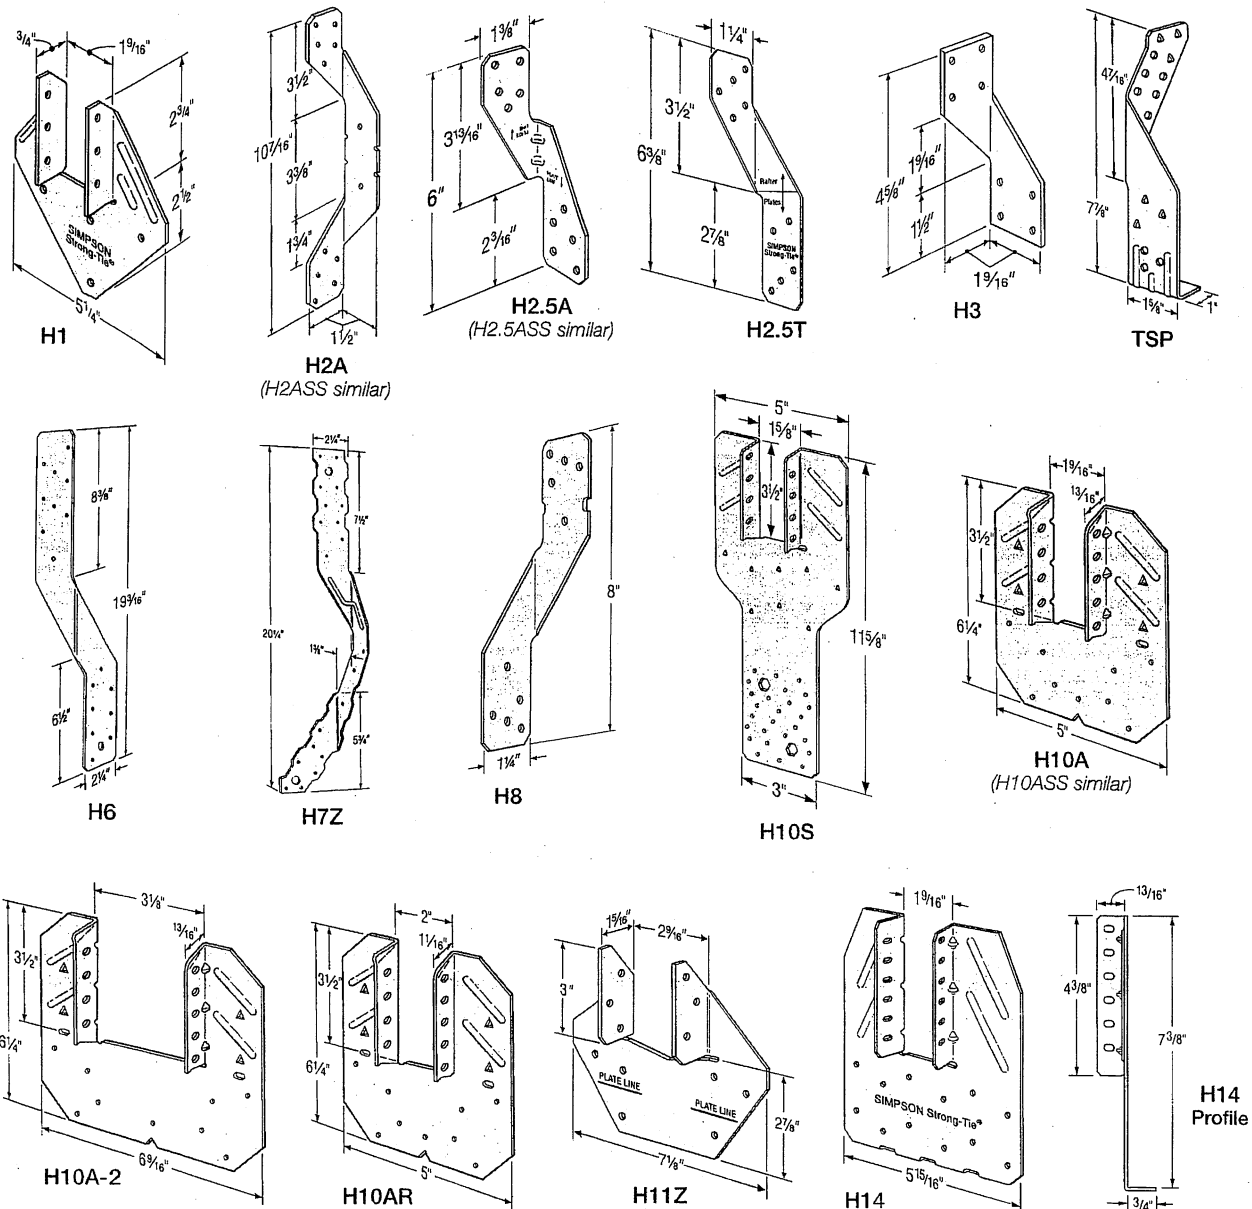

TECHNICAL BULLETIN

H – Seismic and Hurricane Ties

SIMPSON
Strong-Tie

The H connector series provides wind and seismic ties for trusses and rafters.

Material: 18 gauge **Finish:** G90 galvanized

Design: • Factored resistances are in accordance with CSA O86-14


- Factored resistances have been increased 15%. No further increase is permitted.

Installation: • Use all specified fasteners

- Nails: 8d = 0.131" dia. x 2½" long common wire, 8d x 1½" = 0.131" x 1½" long, 10d x 1½" = 0.146" x 1½" long
- H1 can be installed with flanges facing outwards
- Hurricane ties do not replace solid blocking


Factored resistances for more than one direction for a single connection cannot be added together. A factored load which can be divided into components in the directions given must be evaluated as follows: Factored Shear/Resisting Shear + Factored Tension/Resisting Tension ≤ 1.0.

Hurricane Tie Installations to Achieve Twice the Load (Top View)

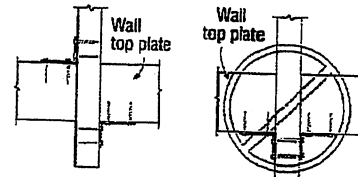


Install diagonally across from each other for minimum 2x truss.


Nailing into both sides of a single ply 2x truss may cause the wood to split.




H1



H1 Installation




H2A




H2A Installation




H2.5A




H2.5A Installation




H2.5T




H2.5T Installation
(Nails into both top plates)




H3



H3 Installation



H10A



H10A Installation

Model No.	Ga.	Fasteners			Factored Resistance (lb.)					
		To Rafter	To Plates	To Studs	D.Fir-L			S-P-F		
					Uplift	Normal		Uplift	Normal	
						F ₁	F ₂		F ₁	F ₂
H1	18	(6) 8d x 1½"	(4) 8d	—	740	685	300	680	485	215
H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	75	590	155	55
H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
H2.5T	18	(5) 8d	(5) 8d	—	835	175	240	740	160	210
H3	18	(4) 8d	(4) 8d	—	740	180	265	615	125	190
H10A	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	565	290

1. Factored resistances have been increased 15% for earthquake or wind loading with no further increase allowed.

2. Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on each side of the joist and on the same side of the plate.

3. When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.

4. Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a Continuous Load Path, connections must be on same side of the wall.



LIMIT
STATES
DESIGN

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPECH20 3/20 exp. 6/22



(800) 999-5099
strongtie.com

TECHNICAL BULLETIN

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1/4". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:

- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.


Optional TC Installation:

- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

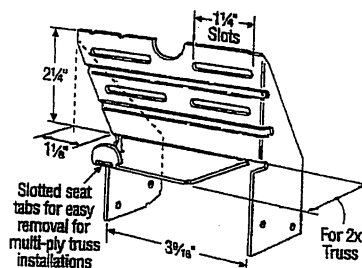


TC24

U.S. Patent 4,932,173

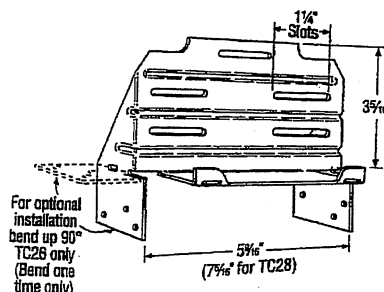


TC26


(TC28 Similar)

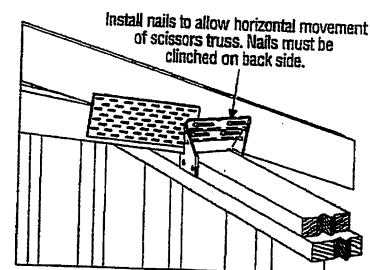

Typical TC24 Installation

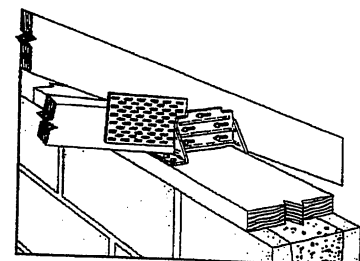

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer
(8", 10", 12" Wall Installation Similar)

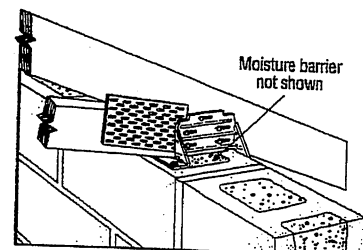


Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _u =1.15)	Uplift (K _u =1.15)
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(6) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _u =1.15)	Uplift (K _u =1.15)
TC26	(5) 10d	(6) 10d x 1 1/2"	810	660
	(5) 10d	(6) 10d	930	660

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.
2. Grout strength is 15 MPa minimum.
3. Optional TC26 installation with 10d nails requires minimum 3" top plate thickness.
4. TC26 fastened to grouted concrete block with (6) - 3/16" x 2 1/4" Titen screws has a factored uplift resistance of 275 lb.

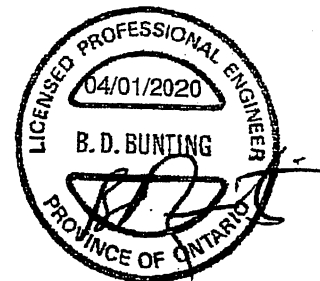

**LIMIT
STATES
DESIGN**

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPECTC20 3/20 exp. 6/22

(800) 999-5099
strongtie.com

HTU

SIMPSON
Strong-Tie


Face-Mount Truss Hanger (cont.)

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Alternate Installation for (2) 2x4 and (2) 2x6 Headers

Model No.	Min. Heel Height (in.)	Minimum Header Size	Fasteners		Factored Resistance			
			Header	Joist	D.Fir-L		S-P-F	
					Uplift	Normal	Uplift	Normal
					(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)
					lb.	lb.	lb.	lb.
					kN	kN	kN	kN
HTU26 (Min.)	3%	(2) 2x4	(10) 16d	(14) 10d x 1 1/2"	1740	3340	1235	2370
					7.74	14.86	5.49	10.54
HTU26 (Max.)	6 1/2"	(2) 2x4	(10) 16d	(20) 10d x 1 1/2"	2470	4015	1755	2850
					10.99	17.86	7.81	12.68
HTU28 (Max.)	3%	(2) 2x6	(20) 16d	(26) 10d x 1 1/2"	4150	6395	2945	4540
					18.46	28.45	13.10	20.19
HTU210 (Max.)	7 1/4"	(2) 2x6	(20) 16d	(32) 10d x 1 1/2"	4150	6395	2945	4540
					18.46	28.45	13.10	20.19

See table footnotes on p. 260.




Hanger Options


See Hanger Options Information on pp. 125-127.

Skewed Seat

- Skewable up to 67 1/2°
- Available in single and 2-ply size
- No bevel cut required



Top View HTU Hanger Skewed Right < 51°



Top View HTU Hanger Skewed Right ≥ 51°

Factored Resistances for Skewed HTU Hangers

Model No.	Skew Angle (Degrees)	Fasteners		Factored Resistance			
		Header	Joist	D.Fir-L		S-P-F	
				Uplift	Normal	Uplift	Normal
				(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)
				lbs	lbs	lbs	lbs
				kN	kN	kN	kN
HTU26	< 51	(20) 16d	(14) 10d x 1 1/2"	1835	4110	1300	2905
				8.16	18.28	5.78	12.92
	51-67 1/2	(20) 16d	(12) 10d x 1 1/2"	1350	3620	965	2560
HTU28	< 51	(26) 16d	(20) 10d x 1 1/2"	6.01	18.10	4.25	11.39
				2810	4270	1985	3030
	51-67 1/2	(26) 16d	(17) 10d x 1 1/2"	12.50	18.99	8.83	13.48
HTU210	< 51	(32) 16d	(26) 10d x 1 1/2"	2075	3930	1465	2780
				9.23	17.48	6.52	12.37
	51-67 1/2	(32) 16d	(22) 10d x 1 1/2"	3795	4430	2675	3135
HTU26-2	< 51	(20) 16d	(14) 10d	16.84	19.71	11.90	13.95
				2795	4240	1980	3000
	51-67 1/2	(20) 16d	(12) 10d	12.43	18.86	8.81	13.35
HTU28-2	< 51	(26) 16d	(20) 10d	2140	3715	1515	2625
				9.52	16.53	6.74	11.68
	51-67 1/2	(26) 16d	(17) 10d	1610	3920	1140	2785
HTU210-2	< 51	(32) 16d	(26) 10d	7.16	17.44	5.07	12.39
				3960	5425	2815	3855
	51-67 1/2	(36) 16d	(22) 10d	17.62	24.13	12.52	17.15
HTU210-2	< 51	(32) 16d	(26) 10d	2385	5425	1695	3855
				10.61	24.13	7.54	17.15
	51-67 1/2	(36) 16d	(22) 10d	5025	6890	3570	4890
				22.35	30.65	15.88	21.75
				3145	6680	2225	4745
				13.99	29.72	9.90	21.10

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Reduced heel heights are not permitted for skewed HTU's.
3. Nails: 16d = 0.162" dia. x 3 1/2" long, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long, 10d = 0.148" dia. x 3" long. See pp. 27-28 for other nail sizes and information.


TN 15-001 Piggyback Bracing

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

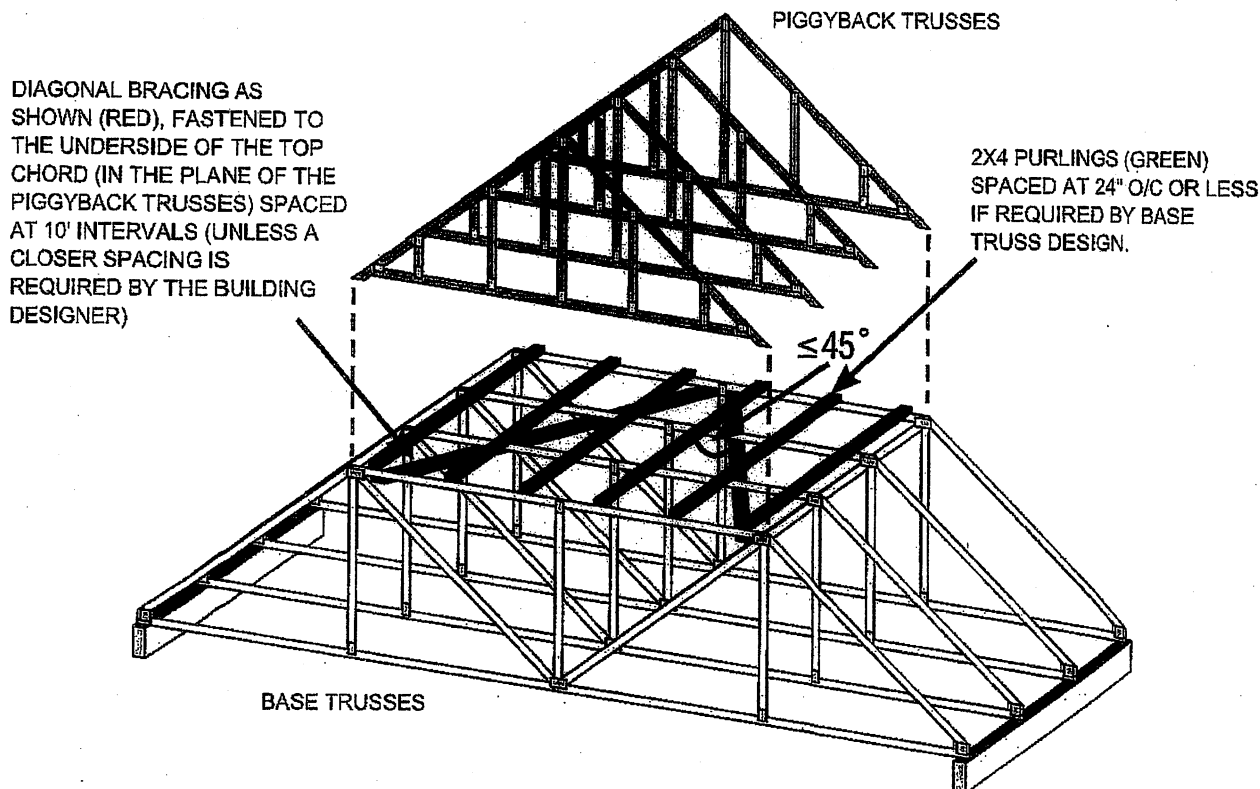

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.

HRS/HST/ST/PS/LSTA/LSTI/MST/MSTA/MSTC/MSTI

Strap Ties

Straps are designed to transfer tension loads in a wide variety of applications.

HRS — Heavy strap designed for installation on the edge of 2x members. The HRS416Z installs with Strong-Drive® SDS Heavy-Duty Connector screws.

LSTA and MSTA — Designed for use on the edge of 2x members, with a nailing pattern that reduces the potential for splitting.

LSTI and MSTI — Light and medium straps that are suitable where pneumatic-nailing is necessary through diaphragm decking and wood chord open-web trusses.


MST — High-capacity strap that can be installed with either nails or bolts. Suitable for double 2x member connections or greater.

MSTC — High-capacity strap that utilizes a staggered nail pattern to help minimize wood splitting. Nail slots have been countersunk to provide a lower nail head profile.

Finish: Galvanized. Some products are available in stainless steel, ZMAX® coating or black powder coat (add PC to sku); contact Simpson Strong-Tie. See Corrosion Information, pp. 18–20.


Installation: Use all specified fasteners; see General Notes

Options: Special sizes can be made to order; contact Simpson Strong-Tie for longer lengths

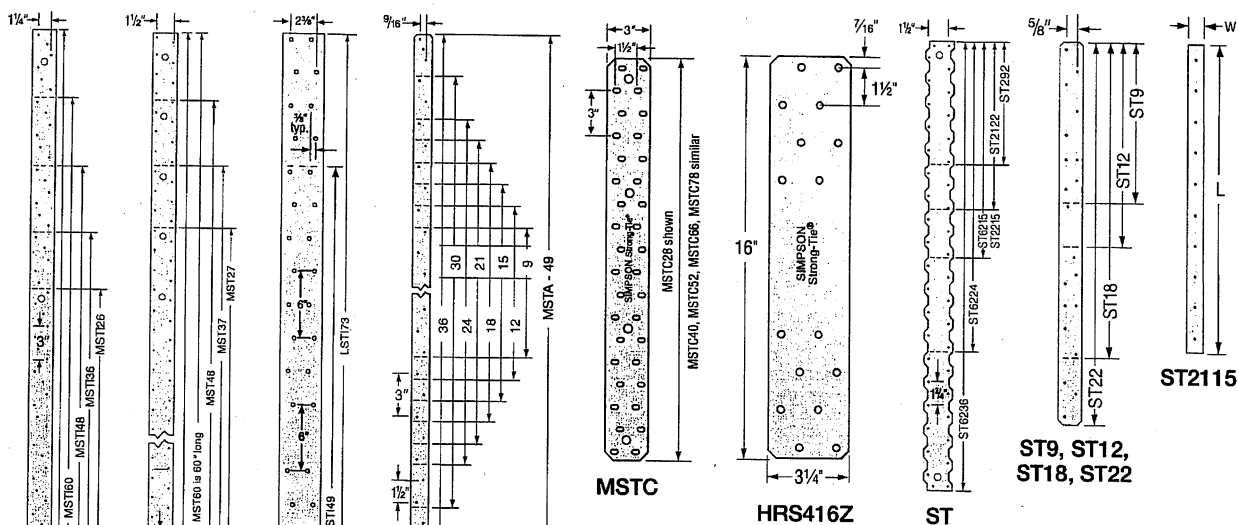


LSTA and MSTA
(Pilot holes not shown)

Stitch nailing
of double studs
by others

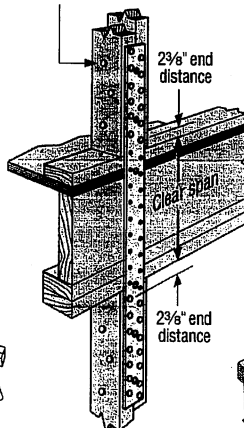


Floor-to-Floor Tie
Installation
Showing a
Clear Span



Typical MSTI Installation
(MIT hanger shown)
LSTI similar

Nails are
not required
in the rim
board area

When nailing
the strap over
wood structural
panel sheathing,
use 2 1/2" long
nail, minimum.

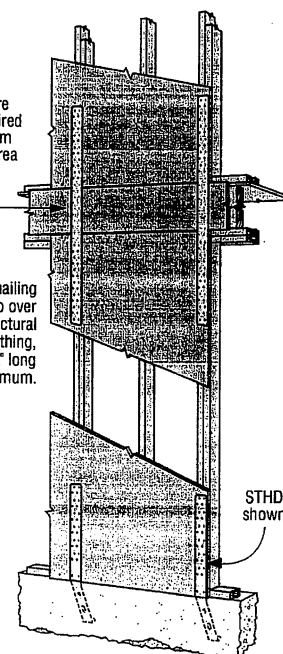

Typical Detail with
Strap Installed over
Wood Structural Panel
Sheathing


HRS/HST/ST/PS/LSTA/LSTI/MST/MSTA/MSTC/MSTI

Strap Ties (cont.)


These products are available with additional corrosion protection. For more information, see p. 20.

SD Many of these products are approved for installation with Strong-Drive® SD Connector screws. See pp. 366–370 for more information.

Model No.	Ga.	Dimensions (in.)		Fasteners (Total)	Factored Tensile Resistance			
					D.Fir-L		S-P-F	
		W	L		(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)
					lb.	lb.	lb.	lb.
					kN	kN	kN	kN
LSTA9	20	1 ¼	9	(6) 10d	600	690	555	635
LSTA12		1 ¼	12	(8) 10d	800	920	735	845
LSTA15		1 ¼	15	(10) 10d	1000	1150	920	1060
LSTA18		1 ¼	18	(12) 10d	1200	1380	1105	1270
LSTA21		1 ¼	21	(14) 10d	1400	1610	1290	1485
LSTA24		1 ¼	24	(16) 10d	1600	1840	1475	1695
ST292		2 ⅝	9 ⅝	(8) 8d	585	675	535	615
ST2122		2 ⅝	12 ⅜	(12) 8d	940	1085	865	995
ST2115		¾	16 ⅝	(8) 8d	670	770	615	710
ST2215		2 ⅝	16 ⅝	(16) 8d	1335	1540	1235	1420
LSTA30	18	1 ¼	30	(20) 10d	2235	2465	2075	2385
LSTA36		1 ¼	36	(24) 10d	2465	2465	2465	2465
LSTI49		3 ¾	49	(32) 10d x 1 ½"	3115	3580	2852	3280
LSTI73		3 ¾	73	(48) 10d x 1 ½"	4670	5370	4280	4920
MSTA9		1 ¼	9	(6) 10d	670	770	625	715
MSTA12		1 ¼	12	(8) 10d	895	1030	830	955
MSTA15		1 ¼	15	(10) 10d	1120	1285	1040	1195
MSTA18		1 ¼	18	(12) 10d	1340	1545	1245	1430
MSTA21		1 ¼	21	(14) 10d	1565	1800	1455	1670
MSTA24		1 ¼	24	(16) 10d	1790	2060	1660	1910
MSTA30	16	1 ¼	30	(20) 10d	2470	2840	2260	2595
MSTA36		1 ¼	36	(24) 10d	2965	3070	2710	3070
MSTA49		1 ¼	49	(28) 8d	2725	2725	2545	2725
ST6215		2 ⅝	16 ⅝	(16) 8d	1405	1615	1300	1500
ST6224		2 ⅝	23 ⅝	(24) 8d	2305	2650	2155	2475
ST9		1 ¼	9	(6) 8d	525	605	490	560
ST12		1 ¼	11 ⅝	(8) 8d	700	805	650	750
ST18		1 ¼	17 ¾	(12) 8d	1050	1210	975	1125
ST22		1 ¼	21 ⅝	(18) 8d	1580	1790	1465	1685
						7.03	7.96	6.52

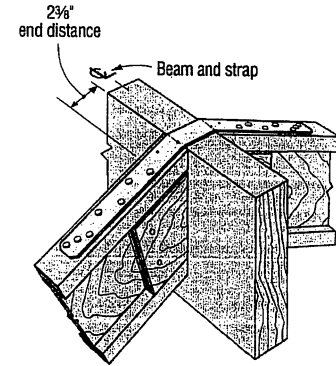

Typical LSTA Installation
(hanger not shown)
Bend strap one time only

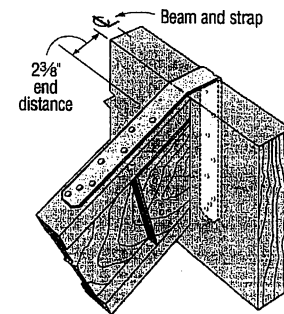

Typical LSTA Installation
(hanger not shown)
Bend strap one time only

Straps and Ties

- Factored resistances have been increased 15% for earthquake or wind loading with no further increase allowed.
- Use half of the nails in each member being connected to achieve the listed resistances.
- Nails:** 10d = 0.148" dia. x 3" long, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long, 8d = 0.131" dia. x 2 1/2" long. See pp. 22–23 for other nail sizes and information.

HRS/HST/ST/PS/LSTA/LSTI/MST/MSTA/MSTC/MSTI
Strap Ties (cont.)



These products are available with additional corrosion protection. For more information, see p. 20.



Many of these products are approved for installation with Strong-Drive® SD Connector screws. See pp. 366–370 for more information.

Model No.	Ga.	Dimensions (in.)		Fasteners (Total)	Factored Tensile Resistance			
					D.Fir-L		S-P-F	
		W	L		(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)
					lb.	lb.	lb.	lb.
					kN	kN	kN	kN
MSTC28	16	3	28¼	(32) 10d	3955	4545	3615	4155
					17.59	20.22	16.08	18.48
MSTC40		3	40¼	(48) 10d	5930	6820	5420	6235
					26.38	30.34	24.11	27.74
MSTC52		3	52¼	(54) 10d	6670	6940	6100	6940
					29.67	30.87	27.14	30.87
MSTC66		3	65¾	(66) 10d	8515	8565	7455	8565
					37.88	38.10	33.16	38.10
MSTC78	14	3	77¾	(66) 10d	8515	8565	7455	8565
					37.88	38.10	33.16	38.10
ST6236		2⅞	33⅞	(36) 8d	3735	4295	3270	3760
					16.61	19.11	14.55	16.73
MSTI26	12	2⅞	26	(22) 10d x 1½"	2825	3250	2475	2850
					12.57	14.46	11.01	12.68
MSTI36		2⅞	36	(32) 10d x 1½"	4110	4725	3600	4140
					18.28	21.02	16.01	18.42
MSTI48		2⅞	48	(44) 10d x 1½"	5650	6500	4955	5695
					25.13	28.91	22.04	25.33
MSTI60		2⅞	60	(56) 10d x 1½"	7195	7360	6305	7250
					32.01	32.74	28.05	32.25
MSTI72		2⅞	72	(68) 10d x 1½"	7360	7360	7240	7360
					32.74	32.74	32.21	32.74
MST27		2⅞	27	(26) 8d	2685	3090	2355	2710
					11.94	13.75	10.48	12.06
MST37		2⅞	37 ½	(38) 8d	3930	4515	3440	3960
					17.48	20.08	15.30	17.62
MST48		2⅞	48	(50) 8d	5170	5945	4530	5210
					23.00	26.45	20.15	23.18
HRS416Z	10	3¼	16	(16) ¼" x 1½" SDS	2400	2760	2120	2440
					10.68	12.28	9.43	10.85
MST60		2⅞	60	(64) 8d	6620	7610	5800	6670
					29.45	33.85	25.80	29.67
MST72		2⅞	72	(78) 8d	8065	9135	7065	8125
					35.88	40.64	31.43	36.14


1. Factored resistances have been increased 15% for earthquake or wind loading with no further increase allowed.
2. Use half of the nails in each member being connected to achieve the listed resistances.
3. Nails: 10d = 0.148" dia. x 3" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long. See pp. 22–23 for other nail sizes and information.

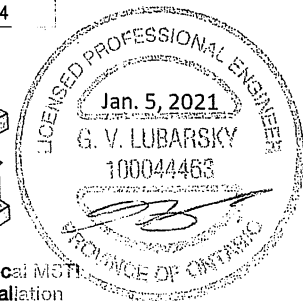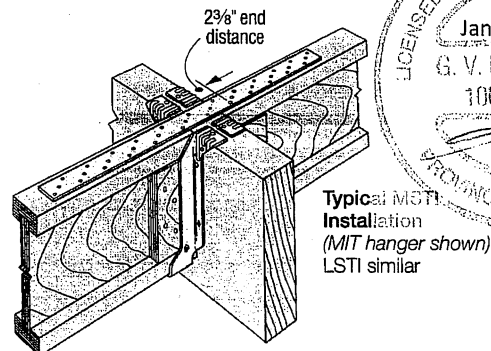

Symbols

PLATE LOCATION AND ORIENTATION

Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



This symbol indicates the required direction of slots in connector plates.



* Plate location details available in Mitek software or upon request.

PLATE SIZE

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.


4 X 4

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.

Industry Standards:

TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

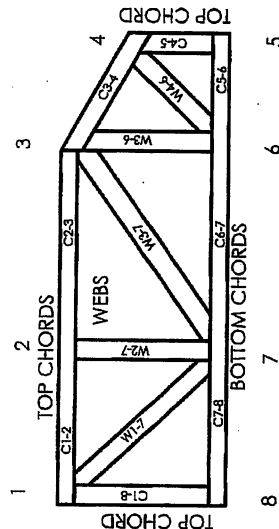

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 Mitek® All Rights Reserved

Mitek
POWER TO PERFORM.™

Mitek Engineering Reference Sheet: MII-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and warps at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.