

Products				
PlotID	Length	Product	Plies	Net Qty
J1	16-00-00	11 7/8" NI-40x	1	24
J2	12-00-00	11 7/8" NI-40x	1	23
J3DJ	12-00-00	11 7/8" NI-40x	2	16
J3	10-00-00	11 7/8" NI-40x	1	48
J4	4-00-00	11 7/8" NI-40x	1	14
B1	16-00-00	1 3/4" x 11 7/8" (2.0E 3100) WestFraser LVL	1	2
B5	16-00-00	1 3/4" x 11 7/8" (2.0E 3100) WestFraser LVL	2	4
B7	14-00-00	1 3/4" x 11 7/8" (2.0E 3100) WestFraser LVL	2	4
B4	10-00-00	1 3/4" x 11 7/8" (2.0E 3100) WestFraser LVL	2	4
B6	8-00-00	1 3/4" x 11 7/8" (2.0E 3100) WestFraser LVL	1	2
B3	8-00-00	1 3/4" x 11 7/8" (2.0E 3100) WestFraser LVL	2	4
B2	6-00-00	1 3/4" x 11 7/8" (2.0E 3100) WestFraser LVL	1	2
R1	212-00-00	1 1/8" x 11 7/8" APA Rim Board	1	1
Bk1	60-00-00	11 7/8" NI-40x	1	1

Connector Summary		
Qty	Manuf	Product
18	H1	IUS2.56/11.88
40	H1	IUS2.56/11.88
8	H1	IUS2.56/11.88
8	H1	IUS2.56/11.88
2	H3	HUS1.81/10
4	H3	HUS1.81/10
6	H4	HGUS410

DWG# TF24030080 TO TF24030086



STRUCTURAL COMPONENTS ONLY  
DWG# TF24030092

THIS IS A FLOOR COMPONENT  
PLACEMENT PLAN ONLY.

The wood beams and joists outlined on this plan are designed as individual building components to be incorporated into the design of the building at the specification of the building designer. Please see the individual beam reports, joist reports, and/or joist span tables for each component identified on this placement plan. The supporting structure is to be specified by the building designer prior to the installation of joist(s) and/or beam(s). The building designer is responsible for the bracing of the floor system and its integration into the bracing of the overall structure. All components labelled "by others" or "as per plan", and all steel beams, are not within the scope of work of this seal. The building designer must review and approve this plan to ascertain conformity to the overall structural plan of the building. All dimensions to be verified on site.

DATE: 3/05/24

1st FLOOR FRAMING  
STD & OPT



FROM PLAN DATED: SEPT 2021

BUILDER: ROYAL PINE HOMES

SITE: SUMMER RIDGE ESTATES

MODEL: 2502

ELEVATION: A1, A2, B1, B2

LOT:

CITY: BRAMPTON

SALESMAN: WILLIAM GARCIA

DESIGNER: EEO

REVISION:

REFER TO THE **NORDIC INSTALLATION** GUIDE FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 SPF #2 REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4/5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 6 AND TABLES 6.1/6.2. **CERAMIC TILE** APPLICATION AS PER OBC 9.30.6.

ALL **CONNECTORS** MUST BE INSTALLED AS PER THE **MANUFACTURER'S SPECIFICATIONS** USING THE MANUFACTURER **SPECIFIED FASTENERS**. ALL **BEAM HANGER FASTENERS** INSTALLED INTO THE **SUPPORTING MEMBER MUST** BE A MINIMUM OF **3.5"** IN LENGTH UNLESS OTHERWISE SPECIFIED BY THE SUPPORTING MEMBER ENGINEER OF RECORD.

LOADING:


LIVE LOAD: 40.0 lb/ft<sup>2</sup>

DEAD LOAD: 15.0 lb/ft<sup>2</sup>

TILE LOAD: +5.0 lb/ft<sup>2</sup>

JOIST LL DEFLECTION LIMIT: L/480

SUBFLOOR: 3/4" GLUED AND NAILED

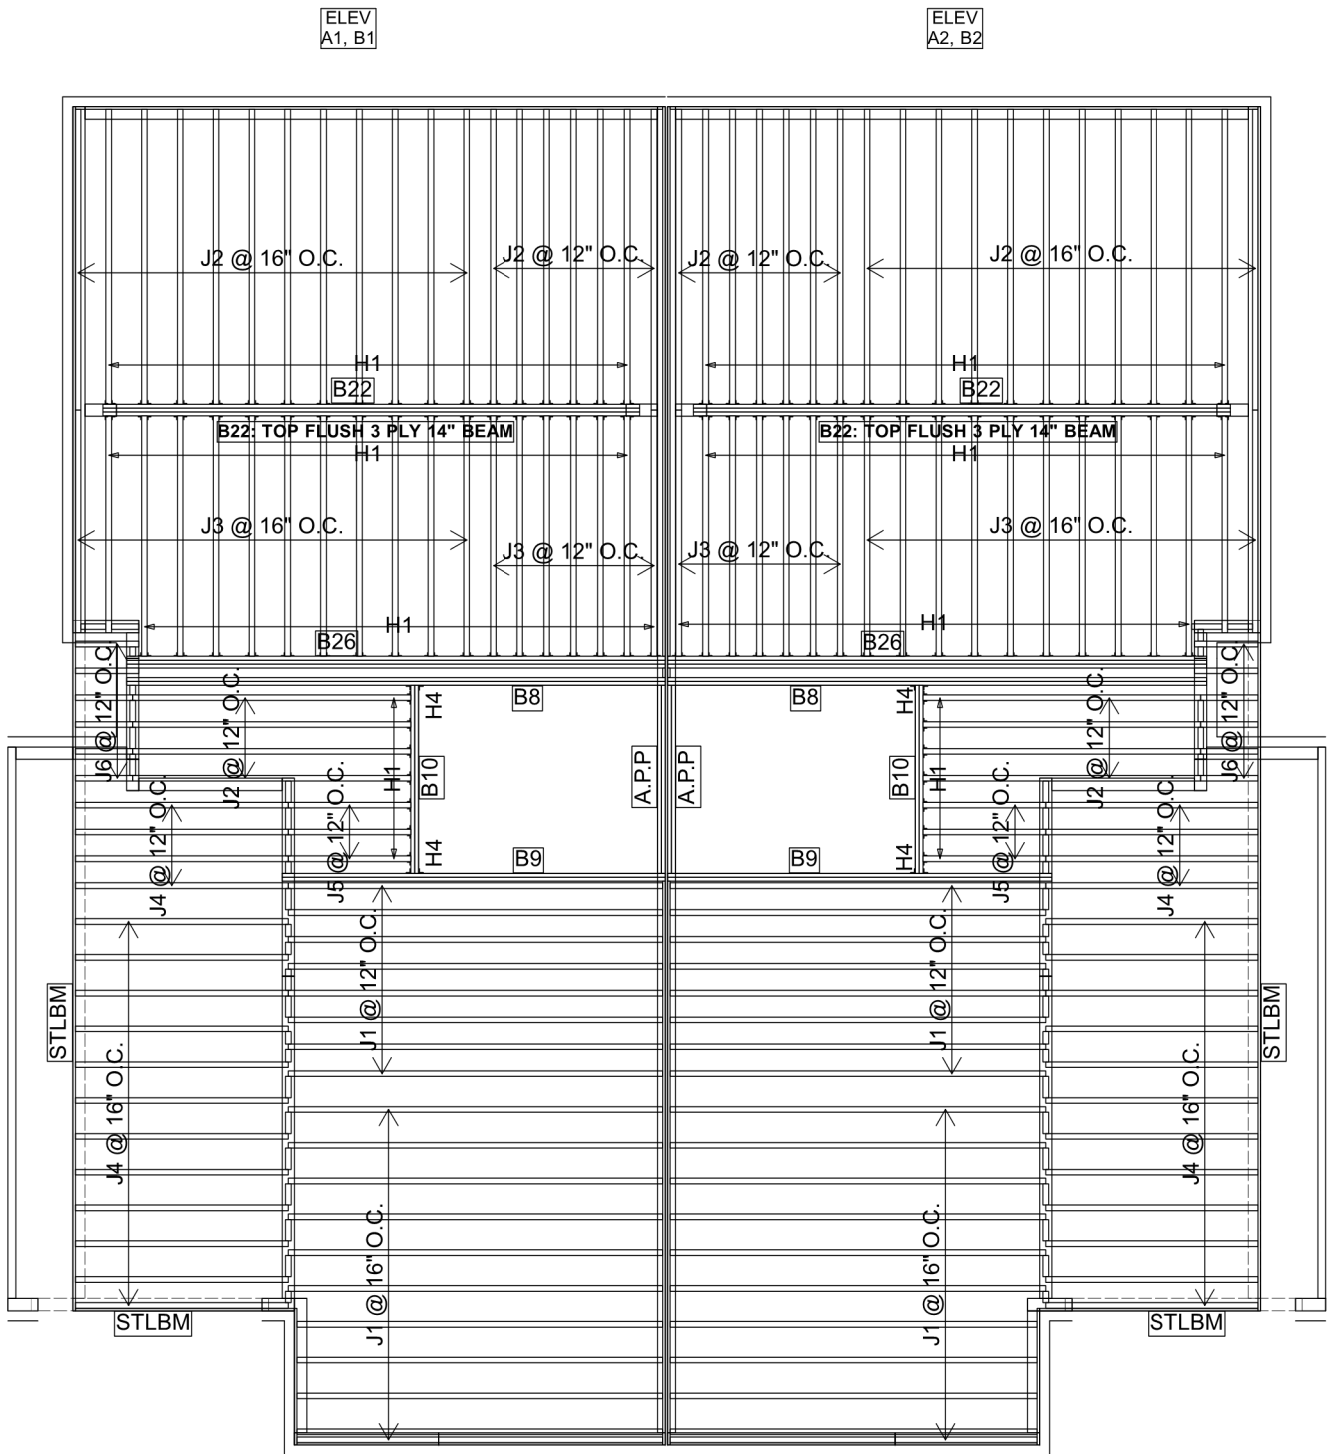

Products				
PlotID	Length	Product	Plies	Net Qty
J1	14-00-00	11 7/8" NI-40x	1	38
J2	12-00-00	11 7/8" NI-40x	1	46
J3	10-00-00	11 7/8" NI-40x	1	38
J4	8-00-00	11 7/8" NI-40x	1	32
J5	6-00-00	11 7/8" NI-40x	1	6
J6	4-00-00	11 7/8" NI-40x	1	12
B8	22-00-00	1 3/4" x 11 7/8" (2.0E 3100) WestFraser LVL	2	4
B26	22-00-00	1 3/4" x 11 7/8" (2.0E 3100) WestFraser LVL	3	6
B9	16-00-00	1 3/4" x 11 7/8" (2.0E 3100) WestFraser LVL	2	4
A.P.P	8-00-00	1 3/4" x 11 7/8" (2.0E 3100) WestFraser LVL	2	4
B10	8-00-00	1 3/4" x 11 7/8" (2.0E 3100) WestFraser LVL	2	4
B22	20-00-00	1 3/4" x 14" (2.0E 3100) WestFraser LVL	3	6
R1	272-00-00	1 1/8" x 11 7/8" APA Rim Board	1	1
Bk1	36-00-00	11 7/8" NI-40x	1	1

Connector Summary		
Qty	Manuf	Product
14	H1	IUS2.56/11.88
34	H1	IUS2.56/11.88
68	H1	IUS2.56/11.88
4	H4	HGUS410

DWG# TF24030087 TO TF24030091



STRUCTURAL COMPONENTS ONLY  
DWG# TF24030093

THIS IS A FLOOR COMPONENT  
PLACEMENT PLAN ONLY.


The wood beams and joists outlined on this plan are designed as individual building components to be incorporated into the design of the building at the specification of the building designer. Please see the individual beam reports, joist reports, and/or joist span tables for each component identified on this placement plan.

The supporting structure is to be specified by the building designer prior to the installation of joist(s) and/or beam(s). The building designer is responsible for the bracing of the floor system and its integration into the bracing of the overall structure. All components labelled "by others" or "as per plan", and all steel beams, are not within the scope of work of this seal.

The building designer must review and approve this plan to ascertain conformity to the overall structural plan of the building. All dimensions to be verified on site.

DATE: 3/05/24

2nd FLOOR FRAMING

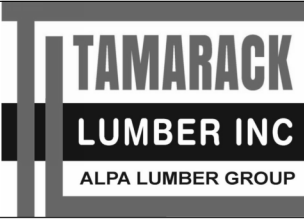

FROM PLAN DATED: SEPT 2021

BUILDER: ROYAL PINE HOMES

SITE: SUMMER RIDGE ESTATES

MODEL: 2502

ELEVATION: A1, A2, B1, B2

LOT:

CITY: BRAMPTON

SALESMAN: WILLIAM GARCIA

DESIGNER: EEO

REVISION:

REFER TO THE **NORDIC INSTALLATION** GUIDE FOR PROPER STORAGE AND INSTALLATION.

**SQUASH BLOCKS** OF 2x4, 2x6, 2x8 SPF #2 REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS.

**MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1.

**CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4/5 FOR REINFORCEMENT REQUIREMENTS.

FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 6 AND TABLES 6.1/6.2.

**CERAMIC TILE** APPLICATION AS PER OBC 9.30.6.

ALL **CONNECTORS** MUST BE INSTALLED AS PER THE **MANUFACTURER'S SPECIFICATIONS** USING THE MANUFACTURER **SPECIFIED FASTENERS**.

ALL **BEAM HANGER FASTENERS** INSTALLED INTO THE **SUPPORTING MEMBER MUST** BE A MINIMUM OF **3.5"** IN LENGTH UNLESS OTHERWISE SPECIFIED BY THE SUPPORTING MEMBER ENGINEER OF RECORD.

**LOADING:**  
LIVE LOAD: 40.0 lb/ft<sup>2</sup>  
DEAD LOAD: 15.0 lb/ft<sup>2</sup>  
TILE LOAD: +5.0 lb/ft<sup>2</sup>

JOIST LL DEFLECTION LIMIT: L/480

SUBFLOOR: 5/8" GLUED AND NAILED

# NORDIC

## INSTALLATION GUIDE NORDIC JOIST

NS-G133   
ENGLISH  
VERSION  
2020-10-01

Engineered Wood Products

## BASIC INSTALLATION GUIDE FOR RESIDENTIAL FLOORS



NORDIC  
STRUCTURES

nordic.ca

### INSTALLING NORDIC I-JOISTS

1. Installation of Nordic I-joists shall be as shown in details 1.
2. Except for cutting to length, I-joist flanges should never be cut, drilled or notched.
3. Install I-joists so that top and bottom flanges are within 1/2 inch of true vertical alignment.
4. Concentrated loads should only be applied to the top surface of the top flange. Concentrated loads should not be suspended from the bottom flange with the exception of light loads, such as ceiling fans or light fixtures.
5. I-joists must be protected from the weather prior to installation.
6. I-joists must not be used in applications where they will be permanently exposed to weather, or will reach a moisture content of 15 percent or greater, such as in swimming pool or hot tub areas. They must not be installed where they will remain in direct contact with concrete or masonry.
7. End bearing length must be at least 1-3/4 inch. For multiple-span joists, intermediate bearing length must be at least 3-1/2 inches.
8. Ends of floor joists shall be restrained to prevent rollover. Use rim board or I-joist blocking panels.
9. I-joists installed beneath bearing walls perpendicular to the joists shall have full-depth blocking panels, rim board, or squash blocks (cripple blocks) to transfer gravity loads from above the floor system to the wall or foundation below.
10. For I-joists installed directly beneath bearing walls parallel to the joists or used as rim board or blocking panels, the maximum vertical load using a single I-joist is 3,300 plf, and 6,000 plf if double I-joists are used.
11. Continuous lateral support of the I-joist's compression flange is required to prevent rotation and buckling. In simple span uses, lateral support of the top flange is normally supplied by the floor sheathing. In multiple-span or cantilever applications, bracing of the I-joist's bottom flange is also required at interior supports of multiple-span joists, and at the end support next to the cantilever extension. The ends of all cantilever extensions must be laterally braced as shown in details 3, 4, or 5.
12. Nails installed in flange face or edge shall be spaced in accordance with the applicable building code requirements or approved building plans, but should not be closer than those specified on page 3.3 of the Nordic Joist Technical Guide (NS-GT3).
13. Details 1 show only I-joist-specific fastener requirements. For other fastener requirements, see the applicable building code.
14. For proper temporary bracing of wood I-joists and placement of temporary construction loads, see [APA Technical Note: Temporary Construction Loads over I-Joist Roofs and Floors, Form J735](#).

All nails shown in the details are assumed to be common nails unless otherwise noted. Nails shall have a diameter not less than 0.128 inch for 2-1/2-inch nails, or 0.144 inch for 3-inch nails. Individual components not shown to scale for clarity.

### SAFETY AND CONSTRUCTION PRECAUTIONS

I-joists are not stable until completely installed, and will not carry any load until fully braced and sheathed.

#### Avoid Accidents by Following these Important Guidelines:

1. Brace and nail each I-joist as it is installed, using hangers, blocking panels, rim board, and/or cross-bridging at joist ends. When I-joists are applied continuous over interior supports and a load-bearing wall is planned at that location, blocking will be required at the interior support.
  2. When the building is completed, the floor sheathing will provide lateral support for the top flanges of the I-joists. Until this sheathing is applied, temporary bracing, often called struts, or temporary sheathing must be applied to prevent I-joist rollover or buckling.
    - Temporary bracing or struts must be 1x4 inch minimum, at least 8 feet long and spaced no more than 8 feet on centre, and must be secured with a minimum of two 2-1/2-inch nails fastened to the top surface of each I-joist. Nail the bracing to a lateral restraint at the end of each bay. Lap ends of adjoining bracing over at least two I-joists.
    - Or, sheathing (temporary or permanent) can be nailed to the top flange of the first 4 feet of I-joists at the end of the bay.
  3. For cantilevered I-joists, brace top and bottom flanges, and brace ends with closure panels, rim board, or cross-bridging.
  4. Install and fully nail permanent sheathing to each I-joist before placing loads on the floor system. Then, stack building materials over beams or walls only.
  5. Never install a damaged I-joist.
- Improper storage or installation, failure to follow applicable building codes, failure to follow span ratings for Nordic I-joists, failure to follow allowable hole sizes and locations, or failure to use web stiffeners when required can result in serious accidents. Follow these installation guidelines carefully.



Do not walk on I-joists until fully fastened and braced, or serious injuries can result.



Never stack building materials over unsheathed I-joists. Once sheathed, do not overstress I-joist with concentrated loads from building materials.

### NORDIC I-JOIST SERIES

#### RESIDENTIAL SERIES

<b>NI-20</b> <b>2x3</b> S-P-F No. 2 3/8 in. web
<b>Depths</b> 9-1/2 and 11-7/8 in.
33 pieces per unit

<b>NI-40x</b> <b>2x3</b> 1950F MSR 3/8 in. web
<b>Depths</b> 9-1/2, 11-7/8 and 14 in.
33 pieces per unit

<b>NI-60</b> <b>2x3</b> 2100F MSR 3/8 in. web
<b>Depths</b> 9-1/2, 11-7/8, 14 and 16 in.
33 pieces per unit

<b>NI-80</b> <b>2x4</b> 2100F MSR 3/8 in. web
<b>Depths</b> 9-1/2, 11-7/8, 14 and 16 in.
23 pieces per unit

<b>NI-90</b> <b>2x4</b> 2400F MSR 3/8 in. web
<b>Depths</b> 11-7/8, 14 and 16 in.
23 pieces per unit

<b>RIM BOARDS</b>
<b>Width</b> 1-1/8 in.
<b>Length</b> 16 ft
<b>Depths</b> 9-1/2 to 16 in.
APA Rim Board Plus

### WEB STIFFENERS

**2**

**Concentrated Load (Load Stiffener)**

Tight joint, no gap

Gap

End Bearing (Bearing Stiffener)

Gap

Tight joint, no gap

Flange width 2-1/2" or 3-1/2"

Approx. 2"

1/8"-1/4" Gap

Four 2-1/2" nails, 3" nails required for I-joists with 3-1/2" flange width

No gap

**Stiffener Size Requirements**

Flange width (in.)	Web stiffener size each side of web (in.)
2-1/2	1 x 2-5/16 Minimum width
3-1/2	1-1/2 x 2-5/16 Minimum width

### NAIL SPACING

Nailing into flange face

Nailing into flange edge

**Nailed to Only One Flange Edge (Top View)**

Closest nail spacing

**Nailed to Both Flange Edges (Top View)**

Closest nail spacing

1/2 offset spacing <sup>(a)</sup>

**Recommended Closest Nail Spacing for Fastening Sheathing to I-joist Flanges to Minimize Splitting**

Fastener size (diameter x length)	Flange face nailing <sup>(a)</sup>			Flange edge nailing <sup>(a)</sup>		
	End distance (in.)	Nail spacing (in.)	End distance (in.)	Nail spacing (in.)	Nail spacing (in.)	
0.128" or smaller in diameter, and 3-1/4" or shorter in length	2	2	2	2	4	
					4	
Greater than 0.128" up to 0.148" in diameter, and 3-1/4" or shorter in length	2	3	2	3	6	
					6	

<sup>(a)</sup> If more than one row is required, offset rows a minimum of 1/2 inch and stagger.

<sup>(b)</sup> Closest nail spacing measured from one flange edge. Nails on opposite flange edge must be offset one-half the minimum spacing.

**1a**

Nordic I-joist blocking panel

2-1/2" nails at 6" o.c. to top plate (when used for lateral shear transfer; nail to bearing plate with same nailing as required for floor sheathing)

Attach I-joist to top plate per detail 1b

**1b**

Rim board

One 2-1/2" nail at top and bottom flange

Attach rim board to top plate using 2-1/2" toe-nails at 6" o.c.

One 2-1/2" face nail at each side at bearing

**Note:**  
1. To avoid splitting flange, start nails at least 1-1/2 inch from end of I-joist. Nails may be driven at an angle to avoid splitting of bearing plate.

**1g**

Load-bearing wall above shall align vertically with the wall below. Other conditions, such as offset bearing walls, are not covered by this detail.

Blocking panel required over all interior supports under load-bearing walls or when floor joists are not continuous over support. The NBC requires blocking at load-bearing and non-load-bearing walls constructed with required braced wall panels (shearwalls).

Joist attachment per detail 1b

2-1/2" nails at 6" o.c. to top plate

Nordic I-joist blocking panel per detail 1a

**1h**

Use backer block if hanger load exceeds 360 lbf. Before installing a backer block to a double I-joist, drive three additional 3" nails through the webs and filler block where the backer block will fit. Clinch. Install backer block tight to top flange. Use twelve 3" nails, clinched when possible. Maximum resistance for hanger for this detail = 1,620 lbf.

Double I-joist header

Filler block per detail 1p

Top- or face-mount hanger

Backer block required:  
- Only on the loaded side for top-mount hangers  
- On both sides for face-mount hangers

Flange width (in.)	Material thickness required (in.) <sup>(a)</sup>	Minimum depth (in.) <sup>(b)</sup>
2-1/2	1	5-1/2
3-1/2	1-1/2	7-1/4

<sup>(a)</sup> Minimum grade for backer block material shall be S-P-F No. 2 or better for solid sawn lumber and wood structural panels conforming to CAN/CSA-Q325 Standard.

<sup>(b)</sup> For face-mount hangers use net joist depth minus 3-1/4 inches for joists with 1-1/2-inch-thick flanges.

**Notes:**  
1. Unless hanger sides laterally support the top flange, bearing stiffeners shall be used.  
2. For hanger resistance, see manufacturer's recommendations.  
3. Verify double I-joist resistance to support concentrated loads.  
4. Backer blocks must be long enough to permit required nailing without splitting.

**1j**

Top- or face-mount hanger installed per manufacturer's recommendations

**1k**

2x plate flush with inside face of wall or beam. 1/8" overhang allowed past inside face of wall or beam.

Top-mount hanger installed per manufacturer's recommendations

**1l**

Install hanger per manufacturer's recommendations

Multiple I-joist header with full depth filler block shown. Nordic Lam or SCL headers may also be used. Verify header resistance to support concentrated loads.

Backer block per detail 1h

Filler block per detail 1p

**Note:**  
1. See detail 1h for maximum support resistance.

**1m**

Do not bevel-cut I-joist beyond inside face of wall

Attach I-joist per detail 1b

**Note:**  
1. Blocking required at bearing for lateral support, not shown for clarity.

**1p**

Filler block

Offset nails from opposite face by 6"

1/8" to 1/4" gap between top flange and filler block

**Notes:**  
1. Support back of I-joist web during nailing to prevent damage to web/flange connection.  
2. Leave a 1/8-inch to 1/4-inch gap between top of filler block and bottom of top I-joist flange.  
3. Filler block is required between joists for full length of span.  
4. For flange width of 2-1/2 inches, nail joists together with two rows of 3-inch nails at 12 inches o.c. (clinched when possible) on each side of the double I-joist (total of four nails per foot). For flange width of 3-1/2 inches, use two rows of 3-inch nails at 6 inches o.c. on each side of the double I-joist (total of eight nails per foot).  
5. The maximum factored load may be applied to one side of the double I-joist using this detail is 860 kN.

**Filler Block Requirements for Double I-joist Construction**

Flange width (in.)	Net depth (in.)	Filler block size (in.)	Example
2-1/2	9-1/2	2-1/8 to 2-1/4 x 6	2x8 x 5/8" or 3/4" sheathing
	11-7/8	2-1/8 to 2-1/4 x 8	2x8 x 5/8" or 3/4" sheathing
	14	2-1/8 to 2-1/4 x 10	2x10 x 5/8" or 3/4" sheathing
3-1/2	9-1/2	3 x 6	2 x 2x6
	11-7/8	3 x 8	2 x 2x6
	14	3 x 10	2 x 2x10

**Note:**  
1. The height of the filler block may be different from that specified in the table, as long as it allows nailing and respects the required gap.

**1s-1**

See note 2

1/8" gap minimum

One 2-1/2" nail at top and bottom flange

Rim board

2-1/2" nails at 6" o.c.

One 2-1/2" nail, one side only

2x4 minimum

Blocking panel (note 1)

**Notes:**  
1. In some local codes, blocking panels are prescriptively required in the first joist space (or first and second joist spaces) next to the starter joist. Where required, see local code requirements for spacing of the blocking panels. As a minimum, it is recommended to use blocking panels spaced at 4 feet on centre.  
2. Details shown are for minimum blocking attachment. Transfer of lateral loads may require additional fasteners. In such cases, nail size, spacing and specific design detailing shall be provided by the building designer.  
3. Where blocking panels are required between adjacent joists, the blocking panels can be staggered by approximately 3 inches, and end-nails as shown.  
4. Nails attaching lumber piece to I-joist web should be driven from the web side and clinched on the lumber side.

**This document supersedes all previous versions. For the latest version, consult nordic.ca or contact Nordic Structures.**


**FOR ALL construction details →DC3**

### WEB HOLES AND OPENINGS

#### WEB HOLES IN I-JOISTS

##### Rules for Cutting Holes in I-Joists

1. The distance between the inside edge of the support and the centreline of any hole shall be in compliance with the requirements of Table 6.1.
2. I-joist top and bottom flanges must never be cut, notched or otherwise modified.
3. Whenever possible, field-cut holes should be centred on the middle of the web.
4. The maximum size hole that can be cut into an I-joist web shall equal the clear distance between the flanges of the I-joist minus 1/4 inch. A minimum of 1/8 inch should always be maintained between the top or bottom of the opening and the adjacent I-joist flange.
5. The sides of square holes or longest sides of rectangular holes should not exceed 3/4 of the diameter of the maximum round hole permitted at that location.
6. Where more than one hole is necessary, the distance between adjacent hole edges shall exceed twice the diameter of the largest round hole or twice the size of the largest square hole - or twice the length of the longest side of the longest rectangular hole - and each hole must be sized and located in compliance with the requirements of Table 6.1.
7. Holes measuring 1-1/2 inch or smaller shall be permitted anywhere in a cantilevered section of a joist. Holes of greater size may be permitted subject to verification.
8. A 1-1/2 inch hole or smaller can be placed anywhere in the web provided that it meets the requirements of rule number 6 above.
9. All holes shall be cut in accordance with the restrictions listed above and as illustrated in detail 6a.
10. Limit three maximum-size holes per span.
11. A group of round holes at approximately the same location shall be permitted if it meets the requirements for a single round hole circumscribed around them.

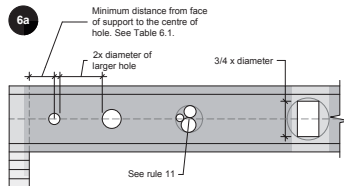


- Notes:**
1. Never drill, cut or notch the flange, or over-cut the web.
  2. Holes in web should be cut with a sharp saw.
  3. For rectangular holes, avoid over-cutting the corners, as this can cause unnecessary stress concentrations. Slightly rounding the corners is recommended. Starting the rectangular hole by drilling a 1-inch-diameter hole in each of the four corners and then making the cuts between the holes is another good method to minimize damage to the I-joist.

#### DUCT CHASE OPENINGS

##### Rules for Cutting Duct Chase Openings in I-joists

1. The distance between the inside edge of the support and the centreline of a duct chase opening shall be in compliance with the requirements of Table 6.2.
2. I-joist top and bottom flanges must never be cut, notched or otherwise modified.
3. The maximum depth of a duct chase opening that can be cut into an I-joist web shall equal the clear distance between the flanges of the I-joist minus 1/4 inch. A minimum of 1/8 inch should always be maintained between the top or bottom of the opening and the adjacent I-joist flange.
4. All openings shall be cut in accordance with the restrictions listed above and as illustrated in detail 6b.
5. Limit one maximum-size duct chase opening per span.

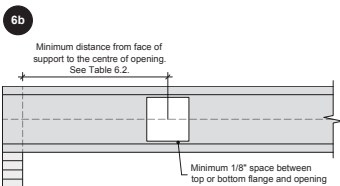


- Notes:**
1. Never drill, cut or notch the flange, or over-cut the web.
  2. Holes in web should be cut with a sharp saw.
  3. Avoid over-cutting the corners, as this can cause unnecessary stress concentrations. Slightly rounding the corners is recommended. Starting the rectangular hole by drilling a 1-inch-diameter hole in each of the four corners and then making the cuts between the holes is another good method to minimize damage to the I-joist.

#### HOLES IN BLOCKING PANELS

##### Maximum Allowable Hole Size in Lateral-restraint-only Blocking Panels

1. The maximum allowable hole size for a lateral-restraint-only blocking panel is 2/3 of the lesser dimension of the blocking's depth or length. Assuming the blocking panel is longer than its height (or depth), the table aside applies. For other applications, contact Nordic Structures.
2. Holes cut into the blocking panels are subject to the following limitations:
  - The top and bottom flanges of an I-joist blocking panel must never be cut, notched or otherwise modified.
  - Field-cut holes must be centred in the blocking horizontally.
  - While round holes are preferred, rectangle holes may be used provided the corners are not over cut. Slightly rounding corners or pre-drilling corners with a 1-inch-diameter bit is recommended.
- All holes must be cut in a workman-like manner in accordance with the limitations listed above.

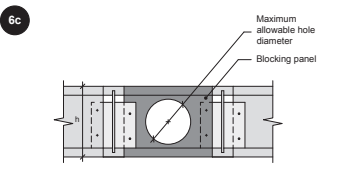

I-joist or rim board blocking depth (in.)	Maximum allowable hole diameter or (in.) <sup>(a)</sup>
9-1/2	6-1/4
11-7/8	7-3/4
14	9-3/4
16	10-1/2

<sup>(a)</sup> Maximum allowable hole diameter in blocking panel, where the blocking panel is longer than its height.

TABLE 6.1 - LOCATION OF WEB HOLES

Simple or multiple span		Minimum distance from inside face of any support to centre of hole (ft.-in.)															
Joist depth	Joist series	2	3	4	5	6	6-1/4	7	8	8-5/8	9	10	10-3/4	11	12	12-3/4	
9-1/2"	NI-20	0'-7"	1'-6"	2'-10"	4'-3"	5'-8"	6'-0"	-	-	-	-	-	-	-	-	-	-
	NI-40x	0'-7"	1'-6"	3'-0"	4'-4"	6'-0"	6'-4"	-	-	-	-	-	-	-	-	-	-
	NI-60	1'-3"	2'-6"	4'-0"	5'-4"	7'-0"	7'-5"	-	-	-	-	-	-	-	-	-	-
	NI-80	2'-3"	3'-6"	5'-0"	6'-6"	8'-2"	8'-8"	-	-	-	-	-	-	-	-	-	-
11-7/8"	NI-20	0'-7"	0'-8"	1'-0"	2'-4"	3'-8"	4'-0"	5'-0"	6'-8"	7'-9"	-	-	-	-	-	-	-
	NI-40x	0'-7"	0'-8"	1'-3"	2'-8"	4'-0"	4'-4"	5'-5"	7'-2"	8'-4"	-	-	-	-	-	-	-
	NI-60	0'-7"	1'-8"	3'-0"	4'-3"	5'-9"	6'-0"	7'-3"	6'-10"	10'-0"	-	-	-	-	-	-	-
	NI-80	1'-6"	2'-10"	4'-2"	5'-6"	7'-0"	7'-5"	8'-6"	10'-3"	11'-4"	-	-	-	-	-	-	-
14"	NI-20	0'-7"	0'-8"	1'-5"	3'-2"	4'-10"	5'-4"	6'-9"	8'-9"	10'-2"	-	-	-	-	-	-	-
	NI-40x	0'-7"	0'-8"	1'-0"	2'-4"	2'-9"	3'-9"	5'-2"	6'-0"	6'-6"	8'-3"	10'-2"	-	-	-	-	-
	NI-60	0'-7"	0'-8"	1'-8"	3'-0"	4'-3"	4'-8"	5'-8"	7'-2"	8'-0"	8'-8"	10'-4"	11'-9"	-	-	-	-
	NI-80	0'-10"	2'-0"	3'-4"	4'-9"	6'-2"	6'-5"	7'-6"	9'-0"	10'-0"	10'-8"	12'-4"	13'-9"	-	-	-	-
16"	NI-20	0'-7"	0'-8"	0'-10"	2'-5"	4'-0"	4'-5"	5'-9"	7'-5"	8'-8"	9'-4"	11'-4"	12'-11"	-	-	-	-
	NI-40x	0'-7"	0'-8"	0'-8"	1'-6"	2'-10"	3'-2"	4'-2"	5'-8"	6'-4"	7'-0"	8'-5"	9'-8"	10'-2"	12'-2"	13'-9"	-
	NI-60	0'-7"	1'-3"	2'-6"	3'-10"	5'-3"	5'-6"	6'-6"	8'-0"	9'-0"	9'-5"	11'-0"	12'-3"	12'-9"	14'-5"	16'-0"	-
	NI-80	0'-7"	0'-8"	0'-8"	1'-9"	3'-3"	3'-8"	4'-9"	6'-5"	7'-5"	8'-0"	9'-10"	11'-3"	11'-9"	13'-6"	15'-4"	-

- Notes:**
1. Tabulated values are applicable to residential floor construction meeting the above design criteria.
  2. The above table is based on the I-joists being used at their maximum spans. The minimum distance as given above may be reduced for shorter spans; contact your local distributor.

Design Criteria	
Joist spacing	Up to 24 inches
Loads	Live load = 40 psf and dead load = 15 psf
Deflection limits	L/480 under live load and L/240 under total load

TABLE 6.2 - LOCATION OF DUCT CHASE OPENINGS

Simple span		Minimum distance from inside face of any support to centre of opening (ft.-in.)															
Joist depth	Joist series	Duct chase length (in.)															
		8	10	12	14	16	18	20	22	24							
9-1/2"	NI-20	4'-1"	4'-5"	4'-10"	-	-	-	-	-	-	-	-	-	-	-	-	-
	NI-40x	5'-3"	5'-8"	6'-0"	6'-5"	6'-10"	7'-3"	7'-8"	-	-	-	-	-	-	-	-	-
	NI-60	5'-4"	5'-9"	6'-2"	6'-7"	7'-1"	7'-5"	8'-0"	-	-	-	-	-	-	-	-	-
	NI-80	5'-3"	5'-8"	6'-0"	6'-5"	6'-10"	7'-3"	7'-8"	8'-2"	8'-6"	-	-	-	-	-	-	-
11-7/8"	NI-20	5'-9"	6'-2"	6'-6"	-	-	-	-	-	-	-	-	-	-	-	-	-
	NI-40x	6'-8"	7'-2"	7'-6"	8'-1"	8'-6"	9'-1"	9'-6"	-	-	-	-	-	-	-	-	-
	NI-60	7'-3"	7'-8"	8'-0"	8'-6"	9'-0"	9'-3"	9'-9"	-	-	-	-	-	-	-	-	-
	NI-80	7'-2"	7'-7"	8'-0"	8'-5"	8'-10"	9'-3"	9'-8"	10'-2"	10'-8"	-	-	-	-	-	-	-
14"	NI-90	7'-6"	7'-11"	8'-4"	8'-9"	9'-2"	9'-7"	10'-1"	10'-7"	10'-11"	-	-	-	-	-	-	-
	NI-40x	8'-1"	8'-7"	9'-0"	9'-6"	10'-1"	10'-7"	11'-2"	-	-	-	-	-	-	-	-	-
	NI-60	8'-9"	9'-3"	9'-8"	10'-11"	10'-6"	11'-1"	11'-6"	-	-	-	-	-	-	-	-	-
	NI-80	9'-0"	9'-3"	9'-9"	10'-1"	10'-7"	11'-1"	11'-6"	12'-1"	12'-6"	-	-	-	-	-	-	-
16"	NI-90	9'-2"	9'-8"	10'-0"	10'-6"	11'-1"	11'-5"	11'-9"	12'-4"	12'-11"	-	-	-	-	-	-	-
	NI-60	10'-3"	10'-8"	11'-2"	11'-6"	12'-1"	12'-6"	13'-2"	-	-	-	-	-	-	-	-	-
	NI-80	10'-4"	10'-9"	11'-3"	11'-9"	12'-1"	12'-7"	13'-1"	13'-8"	14'-4"	-	-	-	-	-	-	-
	NI-90	10'-9"	11'-2"	11'-8"	12'-0"	12'-6"	13'-0"	13'-6"	14'-2"	14'-10"	-	-	-	-	-	-	-



BUILDER: ROYAL PINE HOMES  
SITE: SUMMER RIDGE ESTATES  
MODEL: 2502  
CITY: BRAMPTON

Job Name: 2502  
Level: 1ST FLR FRAMING  
Label: B1 - i22177  
Type: Beam

1 Ply Member  
1 3/4" x 11 7/8" (2.0E 3100)  
WestFraser LVL


Status:  
Design  
Passed

Illustration Not to Scale. Pitch: 0/12

Designed by Single Member Design Engine in MiTek® Structure Version  
8.6.3.353.Update16.11

Report Version: 2021.03.26

03/05/2024 13:44

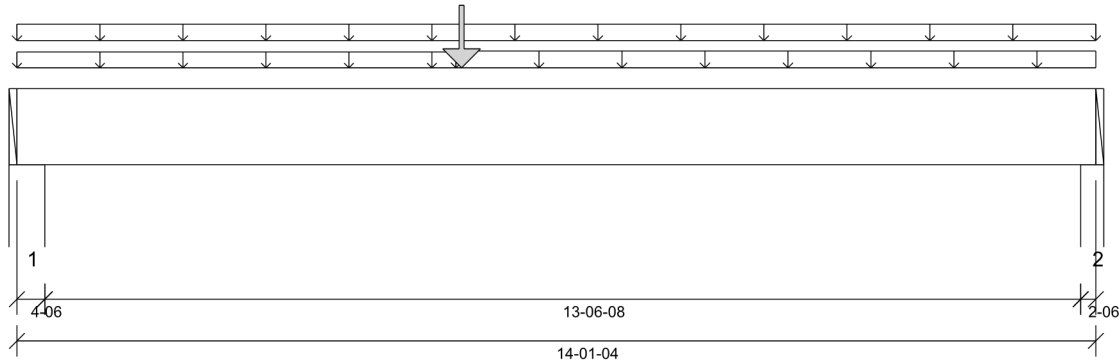

### DESIGN INFORMATION

Building Code: NBCC 2015, Part9, BCBC 2018, ABC 2019, OBC 2012 (2019 Amendment)  
Design Methodology: LSD  
Service Condition: Dry  
LL Deflection Limit: L/360,  
TL Deflection Limit: L/240,

#### Lateral Restraint Requirements:

Both ends of the member and the outer supports must be laterally restrained. Top and bottom edges of the member must be fully restrained or have the following maximum unbraced length:

Top: 0' Bottom: 8'- 1/4"

#### Factored Resistance of Support Material:

- 615 psi Wall @ 0'- 3 3/8"
- 615 psi Wall @ 13'- 11 7/8"

### ANALYSIS RESULTS

Design Criteria	Location	Load Combination	LDF	Design	Limit	Result
Factored Pos. Moment:	5'- 9 3/4"	1.25D + 1.5L	1.00	4704 lb ft	17672 lb ft	Passed - 27%
Factored Shear:	1'- 4 1/4"	1.25D + 1.5L	1.00	914 lb	6908 lb	Passed - 13%
Live Load (LL) Pos. Defl.:	6'- 11"	L		0.111"	L/360	Passed - L/999
Total Load (TL) Pos. Defl.:	6'- 10 3/4"	D + L		0.209"	L/240	Passed - L/778

### SUPPORT AND REACTION INFORMATION

ID	Input Bearing Length	Controlling Load Combination	LDF	Factored Downward Reaction	Factored Uplift Reaction	Factored Resistance of Member	Factored Resistance of Support	Result
1	4'-06"	1.25D + 1.5L	1.00	967 lb		7963 lb	4710 lb	Passed - 21%
2	2'-06"	1.25D + 1.5L	1.00	850 lb		4323 lb	2557 lb	Passed - 33%

### SPECIFIED LOADS

Type	Start Loc	End Loc	Source	Face	Dead (D)	Live (L)	Snow (S)	Wind (W)
Self Weight	0'	14'- 1 1/4"	Self Weight	Top	6 lb/ft	-	-	-
Uniform	0'	14'- 1 1/4"	FC1 Floor Decking (Plan View Fill)	Top	6 lb/ft	11 lb/ft	-	-
Uniform	0'	5'- 8 7/8"	FC1 Floor Decking (Plan View Fill)	Top	2 lb/ft	3 lb/ft	-	-
Uniform	5'- 8 7/8"	14'- 1 1/4"	FC1 Floor Decking (Plan View Fill)	Top	8 lb/ft	16 lb/ft	-	-
Point	5'- 9 3/4"	5'- 9 3/4"	B2(i22161)	Front	374 lb	395 lb	-	-

### UNFACTORED REACTIONS

ID	Start Loc	End Loc	Source	Dead (D)	Live (L)	Snow (S)	Wind (W)
1	0'	0'- 4 3/8"	W30(i3922)	334 lb	370 lb	-	-
2	13'- 10 7/8"	14'- 1 1/4"	W14(i3905)	277 lb	332 lb	-	-

### DESIGN NOTES

- The dead loads used in the design of this member were applied to the structure as sloped dead loads.
- Analysis and Design has been performed using precision loading from actual modeled conditions. Some loads may have been modified to simplify reporting.
- Tributary Loads have been generated based on actual spacing between members in the model which may differ from the default system spacing. The actual loads applied to the member are shown in the Specified Loads table.
- Transfer reactions may differ from design results as allowed per building codes and standard load distribution practices.
- This report is based on modeled conditions input by the user. Source information for the loads and supports are provided for reference only. Verify that all loads and support conditions are correct.
- Review all loads and reactions to ensure that the member/bearing/connector/structure can resist adequately. Unless already specified on this report, anchorage for uplift reactions to be specified by others. Installation of member and accessories (if required) as per manufacturer's instruction.
- Beam Stability Factor used in the calculation for Allowable Max Pos Moment (KL) = 1.00
- When the applied loads are coming from a member/post/wall above that does not sit directly on this beam, adequate load transfer elements, such as squash blocks, wall studs, or beveled plates are required to transfer the loads to this beam.
- Bearing length at support 1 was calculated based on the actual bearing area divided by the supported member width and may not match expected value when bearing is not rectangular or when the supported member is not supported by its full width.



STRUCTURAL COMPONENT ONLY  
DWG # TF24030080





BUILDER: **ROYAL PINE HOMES**  
SITE: **SUMMER RIDGE ESTATES**  
MODEL: **2502**  
CITY: **BRAMPTON**

Job Name: **2502**  
Level: **1ST FLR FRAMING**  
Label: **B2 - i22161**  
Type: **Beam**


**1 Ply Member**  
**1 3/4" x 11 7/8" (2.0E 3100)**  
**WestFraser LVL**

Status:  
**Design Passed**

Illustration Not to Scale. Pitch: 0/12

Designed by Single Member Design Engine in MiTek® Structure Version 8.6.3.353.Update16.11

Report Version: 2021.03.26 03/05/2024 13:44

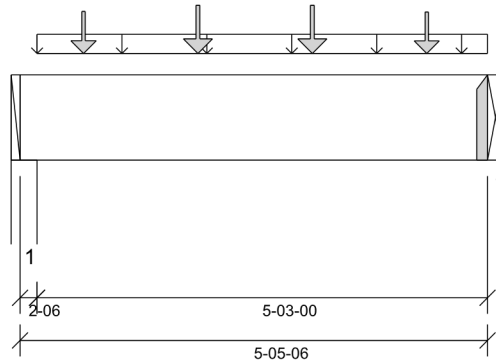

### DESIGN INFORMATION

Building Code: NBCC 2015, Part9, BCBC 2018, ABC 2019, OBC 2012 (2019 Amendment)

Design Methodology: LSD

Service Condition: Dry

LL Deflection Limit: L/360,

TL Deflection Limit: L/240,

#### Lateral Restraint Requirements:

Both ends of the member and the outer supports must be laterally restrained. Top and bottom edges of the member must be fully restrained or have the following maximum unbraced length:

Top: 0' Bottom: 1'- 1 1/2"

#### Factored Resistance of Support Material:

- 615 psi Wall @ 0'- 1 3/8"
- 615 psi Beam @ 5'- 5 3/8"

### ANALYSIS RESULTS

Design Criteria	Location	Load Combination	LDF	Design	Limit	Result
Factored Pos. Moment:	2'- 11 3/16"	1.25D + 1.5L	1.00	1500 lb ft	17672 lb ft	Passed - 8%
Factored Shear:	1'- 2 1/4"	1.25D + 1.5L	1.00	620 lb	6908 lb	Passed - 9%
Total Load (TL) Pos. Defl.:	2'- 9 3/8"	D + L		0.012"	L/240	Passed - L/999

### SUPPORT AND REACTION INFORMATION

ID	Input Bearing Length	Controlling Load Combination	LDF	Factored Downward Reaction	Factored Uplift Reaction	Factored Resistance of Member	Factored Resistance of Support	Result
1	2-06	1.25D + 1.5L	1.00	1088 lb		4322 lb	2557 lb	Passed - 43%
2	1-08	1.25D + 1.5L	1.00	1060 lb		2730 lb	-	Passed - 39%

### CONNECTOR INFORMATION

ID	Part No.	Manufacturer	Nailing Requirements			Other Information or Requirement for Reinforcement Accessories
			Top	Face	Member	
2	HUS1.81/10		-	-	-	Connector manually specified by the user.

\* Connectors: Refer to manufacturer's specifications, fasteners requirements and installation instruction. Where header fasteners are longer than the width of the supporting member, install backer block or clinch header nails.

### SPECIFIED LOADS

Type	Start Loc	End Loc	Source	Face	Dead (D)	Live (L)	Snow (S)	Wind (W)
Self Weight	0'	5'- 5 3/8"	Self Weight	Top	6 lb/ft	-	-	-
Uniform	0'- 2 3/8"	5'- 5 3/8"	User Load	Top	60 lb/ft	-	-	-
Point	0'- 8 7/8"	0'- 8 7/8"	J3(i22175)	Front	91 lb	181 lb	-	-
Point	2'- 7/8"	2'- 7/8"	J3(i22164)	Front	112 lb	224 lb	-	-
Point	3'- 4 7/8"	3'- 4 7/8"	J3(i22168)	Front	112 lb	224 lb	-	-
Point	4'- 8 7/8"	4'- 8 7/8"	J3(i22167)	Front	89 lb	177 lb	-	-

### UNFACTORED REACTIONS

ID	Start Loc	End Loc	Source	Dead (D)	Live (L)	Snow (S)	Wind (W)
1	0'	0'- 2 3/8"	W113(i12804)	378 lb	411 lb	-	-
2	5'- 5 3/8"	5'- 5 3/8"	B1(i22177)	374 lb	395 lb	-	-

### DESIGN NOTES

- The dead loads used in the design of this member were applied to the structure as sloped dead loads.
- Analysis and Design has been performed using precision loading from actual modeled conditions. Some loads may have been modified to simplify reporting.
- Tributary Loads have been generated based on actual spacing between members in the model which may differ from the default system spacing. The actual loads applied to the member are shown in the Specified Loads table.
- Transfer reactions may differ from design results as allowed per building codes and standard load distribution practices.
- This report is based on modeled conditions input by the user. Source information for the loads and supports are provided for reference only. Verify that all loads and support conditions are correct.
- Review all loads and reactions to ensure that the member/bearing/connector/structure can resist adequately. Unless already specified on this report, anchorage for uplift reactions to be specified by others. Installation of member and accessories (if required) as per manufacturer's instruction.
- Beam Stability Factor used in the calculation for Allowable Max Pos Moment (KL) = 1.00
- When the applied loads are coming from a member/post/wall above that does not sit directly on this beam, adequate load transfer elements, such as squash blocks, wall studs, or beveled plates are required to transfer the loads to this beam.



STRUCTURAL COMPONENT ONLY  
DWG # TF24030081



BUILDER: ROYAL PINE HOMES  
SITE: SUMMER RIDGE ESTATES  
MODEL: 2502  
CITY: BRAMPTON

Job Name: 2502  
Level: 1ST FLR FRAMING  
Label: B3 - i21978  
Type: Beam


2 Ply Member  
1 3/4" x 11 7/8" (2.0E 3100)  
WestFraser LVL

Status:  
Design  
Passed

Illustration Not to Scale. Pitch: 0/12

Designed by Single Member Design Engine in MiTek® Structure Version  
8.6.3.353.Update16.11

Report Version: 2021.03.26 03/05/2024 13:44

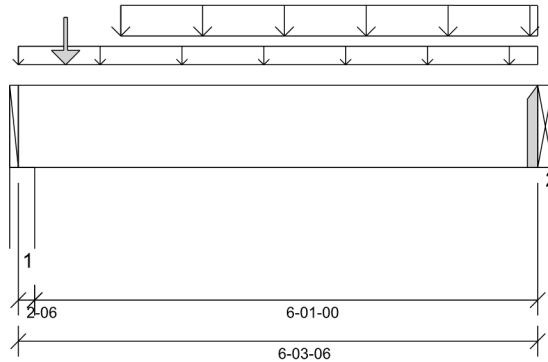

#### DESIGN INFORMATION

Building Code: NBCC 2015, Part9, BCBC 2018, ABC 2019, OBC 2012 (2019 Amendment)  
Design Methodology: LSD  
Service Condition: Dry  
LL Deflection Limit: L/360,  
TL Deflection Limit: L/240,

#### Lateral Restraint Requirements:

Both ends of the member and the outer supports must be laterally restrained. Top and bottom edges of the member must be fully restrained or have the following maximum unbraced length:

Top: 0' Bottom: 1'- 1 1/2"

#### Factored Resistance of Support Material:

- 615 psi Wall @ 0'- 1 3/8"
- 615 psi Beam @ 6'- 3 3/8"

#### ANALYSIS RESULTS

Design Criteria	Location	Load Combination	LDF	Design	Limit	Result
Factored Pos. Moment:	3'- 2 7/8"	1.25D + 1.5L	1.00	2385 lb ft	35345 lb ft	Passed - 7%
Factored Shear:	5'- 3 1/2"	1.25D + 1.5L	1.00	1000 lb	13815 lb	Passed - 7%
Total Load (TL) Pos. Defl.:	3'- 2 3/8"	D + L		0.012"	L/240	Passed - L/999

#### SUPPORT AND REACTION INFORMATION

ID	Input Bearing Length	Controlling Load Combination	LDF	Factored Downward Reaction	Factored Uplift Reaction	Factored Resistance of Member	Factored Resistance of Support	Result
1	2-06	1.25D + 1.5L	1.00	1559 lb		8645 lb	5114 lb	Passed - 30%
2	1-08	1.25D + 1.5L	1.00	1614 lb		5460 lb	-	Passed - 30%

#### CONNECTOR INFORMATION

ID	Part No.	Manufacturer	Nailing Requirements			Other Information or Requirement for Reinforcement Accessories
			Top	Face	Member	
2	HGUS410		-	-	-	Connector manually specified by the user.

\* Connectors: Refer to manufacturer's specifications, fasteners requirements and installation instruction. Where header fasteners are longer than the width of the supporting member, install backer block or clinch header nails.

#### SPECIFIED LOADS

Type	Start Loc	End Loc	Source	Face	Dead (D)	Live (L)	Snow (S)	Wind (W)
Self Weight	0'	6'- 3 3/8"	Self Weight	Top	12 lb/ft	-	-	-
Uniform	0'	6'- 3 3/8"	User Load	Top	60 lb/ft	-	-	-
Tapered	1'- 2 7/8"	6'- 3 3/8"	Smoothed Load	Back	99 To 98 lb/ft	199 To 196 lb/ft	-	-
Point	0'- 6 7/8"	0'- 6 7/8"	J3(i21692)	Back	115 lb	231 lb	-	-

#### UNFACTORED REACTIONS

ID	Start Loc	End Loc	Source	Dead (D)	Live (L)	Snow (S)	Wind (W)
1	0'	0'- 2 3/8"	W23(i3916)	529 lb	599 lb	-	-
2	6'- 3 3/8"	6'- 3 3/8"	B4(i22169)	536 lb	629 lb	-	-

#### DESIGN NOTES

- The dead loads used in the design of this member were applied to the structure as sloped dead loads.
- Lateral stability factor (KL) was based on user preference to use the width of all plies. (Consult with manufacturer for guideline pertaining to this design option.)
- Analysis and Design has been performed using precision loading from actual modeled conditions. Some loads may have been modified to simplify reporting.
- Tributary Loads have been generated based on actual spacing between members in the model which may differ from the default system spacing. The actual loads applied to the member are shown in the Specified Loads table.
- Transfer reactions may differ from design results as allowed per building codes and standard load distribution practices.
- This report is based on modeled conditions input by the user. Source information for the loads and supports are provided for reference only. Verify that all loads and support conditions are correct.
- Review all loads and reactions to ensure that the member/bearing/connector/structure can resist adequately. Unless already specified on this report, anchorage for uplift reactions to be specified by others. Installation of member and accessories (if required) as per manufacturer's instruction.
- Beam Stability Factor used in the calculation for Allowable Max Pos Moment (KL) = 1.00
- When the applied loads are coming from a member/post/wall above that does not sit directly on this beam, adequate load transfer elements, such as squash blocks, wall studs, or beveled plates are required to transfer the loads to this beam.

#### PLY TO PLY CONNECTION

- Member design assumed proper ply to ply connection by others. Fastener spacing along length of member must not exceed 4 times depth of member. Verify connection between plies according to code specification and follow the manufacturer's installation instruction. Loads assumed to be distributed equally to each ply.



STRUCTURAL COMPONENT ONLY  
DWG # TF24030082



BUILDER: ROYAL PINE HOMES  
SITE: SUMMER RIDGE ESTATES  
MODEL: 2502  
CITY: BRAMPTON

Job Name: 2502  
Level: 1ST FLR FRAMING  
Label: B4 - i22169  
Type: Beam


2 Ply Member  
1 3/4" x 11 7/8" (2.0E 3100)  
WestFraser LVL

Status:  
Design  
Passed

Illustration Not to Scale. Pitch: 0/12

Designed by Single Member Design Engine in MiTek® Structure Version  
8.6.3.353.Update16.11

Report Version: 2021.03.26 03/05/2024 13:44

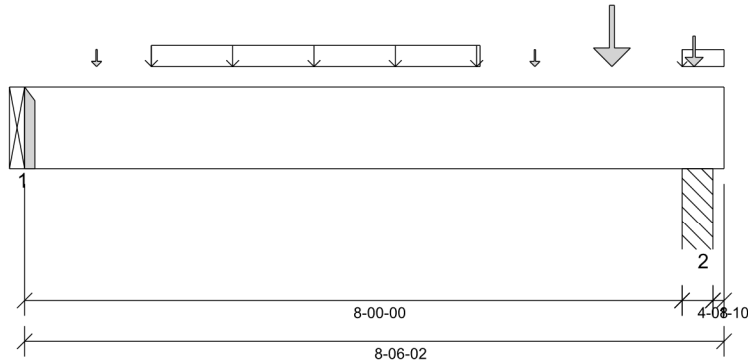

### DESIGN INFORMATION

Building Code: NBCC 2015, Part9, BCBC 2018, ABC 2019, OBC 2012 (2019 Amendment)  
Design Methodology: LSD  
Service Condition: Dry  
LL Deflection Limit: L/180,  
TL Deflection Limit: L/120,

#### Lateral Restraint Requirements:

Both ends of the member and the outer supports must be laterally restrained. Top and bottom edges of the member must be fully restrained or have the following maximum unbraced length:

Top: 0' Bottom: 1'- 1 1/2"

#### Factored Resistance of Support Material:

- 615 psi Beam @ 0'
- 615 psi Column @ 8'- 2 1/4"

**PLY TO PLY CONNECTION:**  
4 ROWS OF 3.25" PNEUMATIC GUN  
NAILS (0.120"x3.25") @ 12" O/C

PLY TO PLY CONNECTION ASSUMES ANY  
SUPPORTED BEAM HANGERS ARE FASTENED  
TO THIS BEAM WITH MIN. 3.5" FASTENERS.

### ANALYSIS RESULTS

Design Criteria	Location	Load Combination	LDF	Design	Limit	Result
Factored Pos. Moment:	7'- 1 3/4"	1.25D + 1.5L	1.00	5090 lb ft	35345 lb ft	Passed - 14%
Factored Shear:	7'- 1/8"	1.25D + 1.5L	1.00	4814 lb	13815 lb	Passed - 35%
Live Load (LL) Pos. Defl.:	4'- 5 7/8"	L		0.025"	L/360	Passed - L/999
Total Load (TL) Pos. Defl.:	4'- 5 7/8"	D + L		0.041"	L/240	Passed - L/999
Permanent Deflection:	8'- 6 1/8"			-	L/360	Passed - L/657

### SUPPORT AND REACTION INFORMATION

ID	Input Bearing Length	Controlling Load Combination	LDF	Factored Downward Reaction	Factored Uplift Reaction	Factored Resistance of Member	Factored Resistance of Support	Result
1	1-08	1.25D + 1.5L	1.00	1285 lb		5460 lb	-	Passed - 24%
2	4-08	1.25D + 1.5L	1.00	6474 lb		16380 lb	9686 lb	Passed - 67%

### CONNECTOR INFORMATION

ID	Part No.	Manufacturer	Top	Face	Member	Nailing Requirements	Other Information or Requirement for Reinforcement Accessories
1	HGUS410		-	-	-		Connector manually specified by the user.

\* Connectors: Refer to manufacturer's specifications, fasteners requirements and installation instruction. Where header fasteners are longer than the width of the supporting member, install backer block or clinch header nails.

### SPECIFIED LOADS

Type	Start Loc	End Loc	Source	Face	Dead (D)	Live (L)	Snow (S)	Wind (W)
Self Weight	0'	8'- 6 1/8"	Self Weight	Top	12 lb/ft	-	-	-
Uniform	1'- 6 1/2"	5'- 6 1/2"	Smoothed Load	Front	38 lb/ft	77 lb/ft	-	-
Uniform	8'	8'- 6 1/8"	FC1 Floor Decking (Plan View Fill)	Top	11 lb/ft	22 lb/ft	-	-
Point	0'- 10 1/2"	0'- 10 1/2"	J4(i22129)	Front	45 lb	90 lb	-	-
Point	6'- 2 1/2"	6'- 2 1/2"	J4(i21634)	Front	43 lb	87 lb	-	-
Point	7'- 1 3/4"	7'- 1 3/4"	B7(i22139)	Front	1391 lb	2154 lb	-	-
Point	8'- 1 3/4"	8'- 1 3/4"	B3(i21978)	Back	536 lb	629 lb	-	-

### UNFACTORED REACTIONS

ID	Start Loc	End Loc	Source	Dead (D)	Live (L)	Snow (S)	Wind (W)
1	0'	0'	B5(i22141)	363 lb	549 lb	-	-
2	8'	8'- 4 1/2"	PBO1(i16243)	1912 lb	2728 lb	-	-

### DESIGN NOTES

- The dead loads used in the design of this member were applied to the structure as sloped dead loads.
- Lateral stability factor (KL) was based on user preference to use the width of all plies. (Consult with manufacturer for guideline pertaining to this design option.)
- Analysis and Design has been performed using precision loading from actual modeled conditions. Some loads may have been modified to simplify reporting.
- Tributary Loads have been generated based on actual spacing between members in the model which may differ from the default system spacing. The actual loads applied to the member are shown in the Specified Loads table.
- Transfer reactions may differ from design results as allowed per building codes and standard load distribution practices.
- This report is based on modeled conditions input by the user. Source information for the loads and supports are provided for reference only. Verify that all loads and support conditions are correct.
- Review all loads and reactions to ensure that the member/bearing/connector/structure can resist adequately. Unless already specified on this report, anchorage for uplift reactions to be specified by others. Installation of member and accessories (if required) as per manufacturer's instruction.
- Beam Stability Factor used in the calculation for Allowable Max Pos Moment (KL) = 1.00
- When the applied loads are coming from a member/post/wall above that does not sit directly on this beam, adequate load transfer elements, such as squash blocks, wall studs, or beveled plates are required to transfer the loads to this beam.

### PLY TO PLY CONNECTION

- Member design assumed proper ply to ply connection by others. Fastener spacing along length of member must not exceed 4 times depth of member. Verify connection between plies according to code specification and follow the manufacturer's installation instruction. Loads assumed to be distributed equally to each ply.



STRUCTURAL COMPONENT ONLY  
DWG # TF24030083



BUILDER: ROYAL PINE HOMES  
SITE: SUMMER RIDGE ESTATES  
MODEL: 2502  
CITY: BRAMPTON

Job Name: 2502  
Level: 1ST FLR FRAMING  
Label: B5 - i22141  
Type: Beam

2 Ply Member  
1 3/4" x 11 7/8" (2.0E 3100)  
WestFraser LVL


Status:  
Design  
Passed

Illustration Not to Scale. Pitch: 0/12

Designed by Single Member Design Engine in MiTek® Structure Version  
8.6.3.353.Update16.11

Report Version: 2021.03.26

03/05/2024 13:44

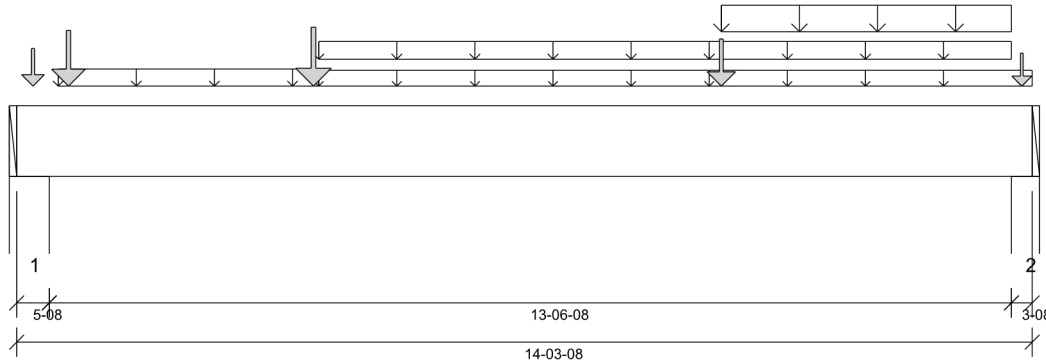

### DESIGN INFORMATION

Building Code: NBCC 2015, Part9, BCBC 2018, ABC 2019, OBC 2012 (2019 Amendment)  
Design Methodology: LSD  
Service Condition: Dry  
LL Deflection Limit: L/360,  
TL Deflection Limit: L/240,

#### Lateral Restraint Requirements:

Both ends of the member and the outer supports must be laterally restrained. Top and bottom edges of the member must be fully restrained or have the following maximum unbraced length:

Top: 0' Bottom: 9'- 9"

#### Factored Resistance of Support Material:

- 615 psi Wall @ 0'- 4 1/2"
- 615 psi Wall @ 14'- 1"

#### PLY TO PLY CONNECTION:

4 ROWS OF 3.25" PNEUMATIC GUN NAILS (0.120"x3.25") @ 12" O/C

PLY TO PLY CONNECTION ASSUMES ANY SUPPORTED BEAM HANGERS ARE FASTENED TO THIS BEAM WITH MIN. 3.5" FASTENERS.

### ANALYSIS RESULTS

Design Criteria	Location	Load Combination	LDF	Design	Limit	Result
Factored Pos. Moment:	8'- 3 11/16"	1.25D + 1.5L	1.00	9226 lb ft	35345 lb ft	Passed - 26%
Factored Shear:	1'- 5 3/8"	1.25D + 1.5L	1.00	3407 lb	13815 lb	Passed - 25%
Live Load (LL) Pos. Defl.:	7'- 3 5/8"	L		0.131"	L/360	Passed - L/999
Total Load (TL) Pos. Defl.:	7'- 3 3/4"	D + L		0.250"	L/240	Passed - L/651

### SUPPORT AND REACTION INFORMATION

ID	Input Bearing Length	Controlling Load Combination	LDF	Factored Downward Reaction	Factored Uplift Reaction	Factored Resistance of Member	Factored Resistance of Support	Result
1	5-08	1.25D + 1.5L	1.00	4195 lb		20020 lb	11843 lb	Passed - 35%
2	3-08	1.25D + 1.5L + S	1.00	3669 lb		12740 lb	7536 lb	Passed - 49%

### SPECIFIED LOADS

Type	Start Loc	End Loc	Source	Face	Dead (D)	Live (L)	Snow (S)	Wind (W)
Self Weight	0'	14'- 3 1/2"	Self Weight	Top	12 lb/ft	-	-	-
Uniform	0'- 7"	4'- 3"	FC1 Floor Decking (Plan View Fill)	Top	17 lb/ft	33 lb/ft	-	-
Uniform	4'- 3"	14'- 3 1/2"	FC1 Floor Decking (Plan View Fill)	Top	8 lb/ft	16 lb/ft	-	-
Uniform	4'- 3"	14'	User Load	Top	60 lb/ft	-	-	-
Uniform	9'- 11"	14'	User Load	Top	80 lb/ft	160 lb/ft	-	-
Point	0'- 8 3/4"	0'- 8 3/4"	B4(i22169)	Back	363 lb	549 lb	-	-
Point	4'- 2 1/8"	4'- 2 1/8"	B6(i22152)	Back	341 lb	642 lb	-	-
Point	0'- 2 3/4"	0'- 2 3/4"	35(i10045)	Top	243 lb	268 lb	-	-
Point	9'- 11"	9'- 11"	User Load	Top	240 lb	480 lb	-	-
Point	14'- 1 3/4"	14'- 1 3/4"	17(i4021)	Top	254 lb	149 lb	3 lb	-

### UNFACTORED REACTIONS

ID	Start Loc	End Loc	Source	Dead (D)	Live (L)	Snow (S)	Wind (W)
1	0'	0'- 5 1/2"	W30(i3922)	1346 lb	1675 lb	-	-
2	14'	14'- 3 1/2"	W14(i3905)	1316 lb	1348 lb	3 lb	-

### DESIGN NOTES

- The dead loads used in the design of this member were applied to the structure as sloped dead loads.
- Lateral stability factor (KL) was based on user preference to use the width of all plies. (Consult with manufacturer for guideline pertaining to this design option.)
- Analysis and Design has been performed using precision loading from actual modeled conditions. Some loads may have been modified to simplify reporting.
- Tributary Loads have been generated based on actual spacing between members in the model which may differ from the default system spacing. The actual loads applied to the member are shown in the Specified Loads table.
- Transfer reactions may differ from design results as allowed per building codes and standard load distribution practices.
- This report is based on modeled conditions input by the user. Source information for the loads and supports are provided for reference only. Verify that all loads and support conditions are correct.
- Review all loads and reactions to ensure that the member/bearing/connector/structure can resist adequately. Unless already specified on this report, anchorage for uplift reactions to be specified by others. Installation of member and accessories (if required) as per manufacturer's instruction.
- Beam Stability Factor used in the calculation for Allowable Max Pos Moment (KL) = 1.00
- When the applied loads are coming from a member/post/wall above that does not sit directly on this beam, adequate load transfer elements, such as squash blocks, wall studs, or beveled plates are required to transfer the loads to this beam.
- Bearing length at support 1 was calculated based on the actual bearing area divided by the supported member width and may not match expected value when bearing is not rectangular or when the supported member is not supported by its full width.

### PLY TO PLY CONNECTION

- Member design assumed proper ply to ply connection by others. Fastener spacing along length of member must not exceed 4 times depth of member. Verify connection between plies according to code specification and follow the manufacturer's installation instruction. Loads assumed to be distributed equally to each ply.



STRUCTURAL COMPONENT ONLY  
DWG # TF24030084





BUILDER: ROYAL PINE HOMES  
SITE: SUMMER RIDGE ESTATES  
MODEL: 2502  
CITY: BRAMPTON

Job Name: 2502  
Level: 1ST FLR FRAMING  
Label: B6 - i22152  
Type: Beam


1 Ply Member  
1 3/4" x 11 7/8" (2.0E 3100)  
WestFraser LVL

Status:  
Design  
Passed

Illustration Not to Scale. Pitch: 0/12

Designed by Single Member Design Engine in MiTek® Structure Version  
8.6.3.353.Update16.11

Report Version: 2021.03.26 03/05/2024 13:44

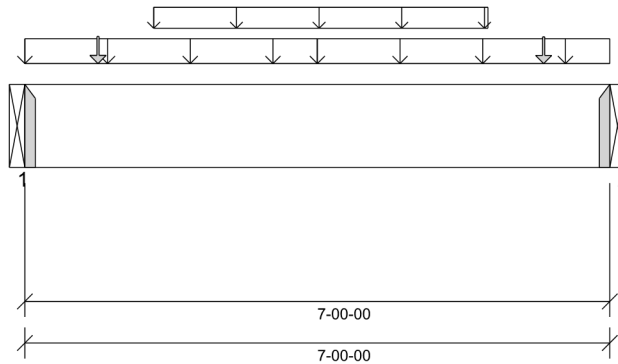

### DESIGN INFORMATION

Building Code: NBCC 2015, Part9, BCBC 2018, ABC 2019, OBC 2012 (2019 Amendment)  
Design Methodology: LSD  
Service Condition: Dry  
LL Deflection Limit: L/360,  
TL Deflection Limit: L/240,

#### Lateral Restraint Requirements:

Both ends of the member and the outer supports must be laterally restrained. Top and bottom edges of the member must be fully restrained or have the following maximum unbraced length:

Top: 0' Bottom: 1'- 1 1/2"

#### Factored Resistance of Support Material:

- 615 psi Beam @ 0'
- 615 psi Beam @ 7'

### ANALYSIS RESULTS

Design Criteria	Location	Load Combination	LDF	Design	Limit	Result
Factored Pos. Moment:	3'- 6 1/2"	1.25D + 1.5L	1.00	2533 lb ft	17672 lb ft	Passed - 14%
Factored Shear:	6'- 1/8"	1.25D + 1.5L	1.00	965 lb	6908 lb	Passed - 14%
Live Load (LL) Pos. Defl.:	3'- 6"	L		0.022"	L/360	Passed - L/999
Total Load (TL) Pos. Defl.:	3'- 6"	D + L		0.033"	L/240	Passed - L/999

### SUPPORT AND REACTION INFORMATION

ID	Input Bearing Length	Controlling Load Combination	LDF	Factored Downward Reaction	Factored Uplift Reaction	Factored Resistance of Member	Factored Resistance of Support	Result
1	1-08	1.25D + 1.5L	1.00	1387 lb		2730 lb	-	Passed - 51%
2	1-08	1.25D + 1.5L	1.00	1394 lb		2730 lb	-	Passed - 51%

### CONNECTOR INFORMATION

ID	Part No.	Manufacturer	Nailing Requirements			Other Information or Requirement for Reinforcement Accessories		
			Top	Face	Member			
1	HUS1.81/10		-	-	-	Connector manually specified by the user.		
2	HUS1.81/10		-	-	-	Connector manually specified by the user.		

\* Connectors: Refer to manufacturer's specifications, fasteners requirements and installation instruction. Where header fasteners are longer than the width of the supporting member, install backer block or clinch header nails.

### SPECIFIED LOADS

Type	Start Loc	End Loc	Source	Face	Dead (D)	Live (L)	Snow (S)	Wind (W)
Self Weight	0'	7'	Self Weight	Top	6 lb/ft	-	-	-
Uniform	0'	3'- 6"	User Load	Top	60 lb/ft	120 lb/ft	-	-
Uniform	1'- 6 1/2"	5'- 6 1/2"	Smoothed Load	Back	35 lb/ft	71 lb/ft	-	-
Uniform	3'- 6"	7'	User Load	Front	60 lb/ft	120 lb/ft	-	-
Point	0'- 10 1/2"	0'- 10 1/2"	J4(i22129)	Back	41 lb	83 lb	-	-
Point	6'- 2 1/2"	6'- 2 1/2"	J4(i21634)	Back	40 lb	80 lb	-	-

### UNFACTORED REACTIONS

ID	Start Loc	End Loc	Source	Dead (D)	Live (L)	Snow (S)	Wind (W)
1	0'	0'	B5(i22141)	341 lb	642 lb	-	-
2	7'	7'	B7(i22139)	342 lb	643 lb	-	-

### DESIGN NOTES

- The dead loads used in the design of this member were applied to the structure as sloped dead loads.
- Analysis and Design has been performed using precision loading from actual modeled conditions. Some loads may have been modified to simplify reporting.
- Tributary Loads have been generated based on actual spacing between members in the model which may differ from the default system spacing. The actual loads applied to the member are shown in the Specified Loads table.
- Transfer reactions may differ from design results as allowed per building codes and standard load distribution practices.
- This report is based on modeled conditions input by the user. Source information for the loads and supports are provided for reference only. Verify that all loads and support conditions are correct.
- Review all loads and reactions to ensure that the member/bearing/connector/structure can resist adequately. Unless already specified on this report, anchorage for uplift reactions to be specified by others. Installation of member and accessories (if required) as per manufacturer's instruction.
- Beam Stability Factor used in the calculation for Allowable Max Pos Moment (KL) = 1.00
- When the applied loads are coming from a member/post/wall above that does not sit directly on this beam, adequate load transfer elements, such as squash blocks, wall studs, or beveled plates are required to transfer the loads to this beam.



STRUCTURAL COMPONENT ONLY  
DWG # TF24030085



BUILDER: ROYAL PINE HOMES  
SITE: SUMMER RIDGE ESTATES  
MODEL: 2502  
CITY: BRAMPTON

Job Name: 2502  
Level: 1ST FLR FRAMING  
Label: B7 - i22139  
Type: Beam


2 Ply Member  
1 3/4" x 11 7/8" (2.0E 3100)  
WestFraser LVL

Status:  
Design  
Passed

Illustration Not to Scale. Pitch: 0/12

Designed by Single Member Design Engine in MiTek® Structure Version  
8.6.3.353.Update16.11

Report Version: 2021.03.26 03/05/2024 13:44

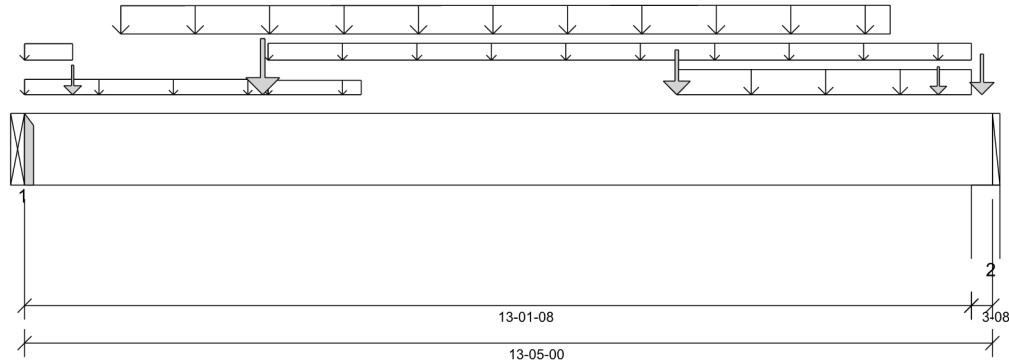

### DESIGN INFORMATION

Building Code: NBCC 2015, Part9, BCBC 2018, ABC 2019, OBC 2012 (2019 Amendment)  
Design Methodology: LSD  
Service Condition: Dry  
LL Deflection Limit: L/360,  
TL Deflection Limit: L/240,

#### Lateral Restraint Requirements:

Both ends of the member and the outer supports must be laterally restrained. Top and bottom edges of the member must be fully restrained or have the following maximum unbraced length:

Top: 0' Bottom: 1'- 1 1/2"

#### Factored Resistance of Support Material:

- 615 psi Beam @ 0'
- 615 psi Wall @ 13'- 2 1/2"

**PLY TO PLY CONNECTION:**  
4 ROWS OF 3.25" PNEUMATIC GUN  
NAILS (0.120"x3.25") @ 12" O/C

PLY TO PLY CONNECTION ASSUMES ANY  
SUPPORTED BEAM HANGERS ARE FASTENED  
TO THIS BEAM WITH MIN. 3.5" FASTENERS.

### ANALYSIS RESULTS

Design Criteria	Location	Load Combination	LDF	Design	Limit	Result
Factored Pos. Moment:	7'- 4"	1.25D + 1.5L	1.00	17391 lb ft	35345 lb ft	Passed - 49%
Factored Shear:	12'- 1 5/8"	1.25D + 1.5L + S	1.00	5203 lb	13815 lb	Passed - 38%
Live Load (LL) Pos. Defl.:	6'- 7 13/16"	L		0.250"	L/360	Passed - L/630
Total Load (TL) Pos. Defl.:	6'- 7 7/8"	D + L		0.421"	L/240	Passed - L/374
Permanent Deflection:	6'- 7 15/16"			-	L/360	Passed - L/946

### SUPPORT AND REACTION INFORMATION

ID	Input Bearing Length	Controlling Load Combination	LDF	Factored Downward Reaction	Factored Uplift Reaction	Factored Resistance of Member	Factored Resistance of Support	Result
1	1-08	1.25D + 1.5L	1.00	4976 lb		5460 lb	-	Passed - 91%
2	3-08	1.25D + 1.5L + S	1.00	6475 lb		12740 lb	7536 lb	Passed - 86%

### CONNECTOR INFORMATION

ID	Part No.	Manufacturer	Top	Face	Member	Nailing Requirements	Other Information or Requirement for Reinforcement Accessories
1	HGUS410		-	-	-		Connector manually specified by the user.
* Connectors: Refer to manufacturer's specifications, fasteners requirements and installation instruction. Where header fasteners are longer than the width of the supporting member, install backer block or clinch header nails.							

### SPECIFIED LOADS

Type	Start Loc	End Loc	Source	Face	Dead (D)	Live (L)	Snow (S)	Wind (W)
Self Weight	0'	13'- 5"	Self Weight	Top	12 lb/ft	-	-	-
Uniform	0'	3'- 4 1/2"	FC1 Floor Decking (Plan View Fill)	Top	9 lb/ft	19 lb/ft	-	-
Uniform	0'	0'- 8"	FC1 Floor Decking (Plan View Fill)	Top	17 lb/ft	34 lb/ft	-	-
Uniform	3'- 4 1/2"	13'- 1 1/2"	User Load	Top	60 lb/ft	-	-	-
Uniform	3'- 4 1/2"	4'- 8"	FC1 Floor Decking (Plan View Fill)	Top	3 lb/ft	6 lb/ft	-	-
Uniform	9'- 1/2"	13'- 1 1/2"	User Load	Top	80 lb/ft	160 lb/ft	-	-
Tapered	1'- 4"	12'	Smoothed Load	Back	102 To 105 lb/ft	202 To 209 lb/ft	-	-
Point	3'- 3 5/8"	3'- 3 5/8"	B6(i22152)	Front	342 lb	643 lb	-	-
Point	0'- 8"	0'- 8"	J3(i21659)	Back	121 lb	243 lb	-	-
Point	12'- 8"	12'- 8"	J3(i21976)	Back	108 lb	217 lb	-	-
Point	9'- 1/2"	9'- 1/2"	User Load	Top	240 lb	480 lb	-	-
Point	13'- 3 1/4"	13'- 3 1/4"	5(i3966)	Top	361 lb	257 lb	5 lb	-

### UNFACTORED REACTIONS


ID	Start Loc	End Loc	Source	Dead (D)	Live (L)	Snow (S)	Wind (W)
1	0'	0'	B4(i22169)	1391 lb	2154 lb	-	-
2	13'- 1 1/2"	13'- 5"	W14(i3905)	2007 lb	2644 lb	5 lb	-

### DESIGN NOTES

- The dead loads used in the design of this member were applied to the structure as sloped dead loads.
- Lateral stability factor (KL) was based on user preference to use the width of all plies. (Consult with manufacturer for guideline pertaining to this design option.)
- Analysis and Design has been performed using precision loading from actual modeled conditions. Some loads may have been modified to simplify reporting.
- Tributary Loads have been generated based on actual spacing between members in the model which may differ from the default system spacing. The actual loads applied to the member are shown in the Specified Loads table.
- Transfer reactions may differ from design results as allowed per building codes and standard load distribution practices.
- This report is based on modeled conditions input by the user. Source information for the loads and supports are provided for reference only. Verify that all loads and support conditions are correct.
- Review all loads and reactions to ensure that the member/bearing/connector/structure can resist adequately. Unless already specified on this report, anchorage for uplift reactions to be specified by others. Installation of member and accessories (if required) as per manufacturer's instruction.
- Beam Stability Factor used in the calculation for Allowable Max Pos Moment (KL) = 1.00



STRUCTURAL COMPONENT ONLY  
DWG # TF24030086 PG 1/2

	BUILDER:	ROYAL PINE HOMES	Job Name:	2502	2 Ply Member 1 3/4" x 11 7/8" (2.0E 3100) WestFraser LVL	Status: Design Passed
	SITE:	SUMMER RIDGE ESTATES	Level:	1ST FLR FRAMING		
	MODEL:	2502	Label:	B7 - i22139		
	CITY:	BRAMPTON	Type:	Beam		

- When the applied loads are coming from a member/post/wall above that does not sit directly on this beam, adequate load transfer elements, such as squash blocks, wall studs, or beveled plates are required to transfer the loads to this beam.

PLY TO PLY CONNECTION

- Member design assumed proper ply to ply connection by others. Fastener spacing along length of member must not exceed 4 times depth of member. Verify connection between plies according to code specification and follow the manufacturer's installation instruction. Loads assumed to be distributed equally to each ply.





BUILDER: ROYAL PINE HOMES  
SITE: SUMMER RIDGE ESTATES  
MODEL: 2502  
CITY: BRAMPTON

Job Name: 2502  
Level: 2ND FLR FRAMING  
Label: B8 - i21883  
Type: Beam

2 Ply Member  
1 3/4" x 11 7/8" (2.0E 3100)  
WestFraser LVL


Status:  
Design  
Passed

Illustration Not to Scale. Pitch: 0/12

Designed by Single Member Design Engine in MiTek® Structure Version  
8.6.3.353.Update16.11

Report Version: 2021.03.26

03/05/2024 13:44

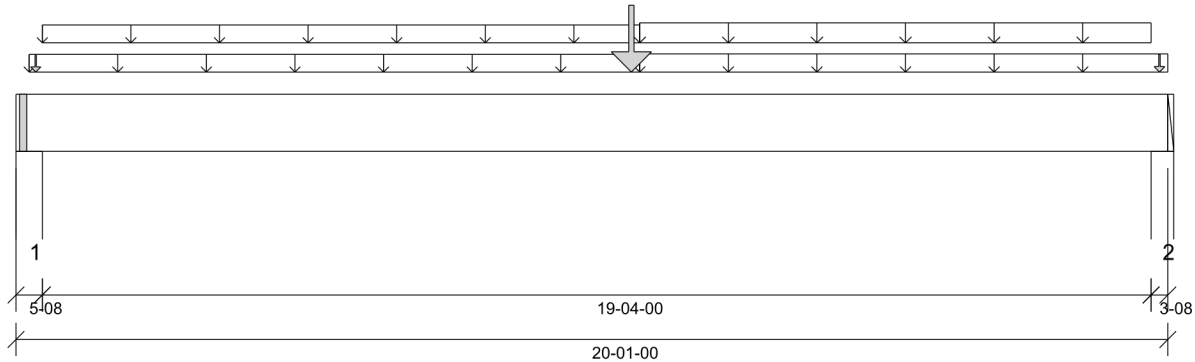

#### DESIGN INFORMATION

Building Code: NBCC 2015, Part9, BCBC 2018, ABC 2019, OBC 2012 (2019 Amendment)  
Design Methodology: LSD  
Service Condition: Dry  
LL Deflection Limit: L/360,  
TL Deflection Limit: L/240,

#### Lateral Restraint Requirements:

Both ends of the member and the outer supports must be laterally restrained. Top and bottom edges of the member must be fully restrained or have the following maximum unbraced length:  
Top: 0' Bottom: 10'- 1 1/2"

#### Factored Resistance of Support Material:

- 615 psi Wall @ 0'- 4 1/2"
- 615 psi Wall @ 19'- 10 1/2"

PLY TO PLY CONNECTION:  
4 ROWS OF 3.25" PNEUMATIC GUN  
NAILS (0.120"x3.25") @ 12" O/C

PLY TO PLY CONNECTION ASSUMES ANY  
SUPPORTED BEAM HANGERS ARE FASTENED  
TO THIS BEAM WITH MIN. 3.5" FASTENERS.

#### ANALYSIS RESULTS

Design Criteria	Location	Load Combination	LDF	Design	Limit	Result
Factored Pos. Moment:	10'- 8 3/4"	1.25D + 1.5L	0.98	14722 lb ft	34630 lb ft	Passed - 43%
Factored Shear:	18'- 9 5/8"	1.25D + 1.5L	0.98	2053 lb	13536 lb	Passed - 15%
Live Load (LL) Pos. Defl.:	10'- 3"	L		0.346"	L/360	Passed - L/670
Total Load (TL) Pos. Defl.:	10'- 4 1/16"	D + L		0.662"	L/240	Passed - L/350
Permanent Deflection:	10'- 5 5/16"			-	L/360	Passed - L/757

#### SUPPORT AND REACTION INFORMATION

ID	Input Bearing Length	Controlling Load Combination	LDF	Factored Downward Reaction	Factored Uplift Reaction	Factored Resistance of Member	Factored Resistance of Support	Result
1	5-08	1.25D + 1.5L	0.98	1800 lb		19615 lb	11603 lb	Passed - 16%
2	3-08	1.25D + 1.5L + S	0.98	2229 lb		12488 lb	7387 lb	Passed - 30%

#### SPECIFIED LOADS

Type	Start Loc	End Loc	Source	Face	Dead (D)	Live (L)	Snow (S)	Wind (W)
Self Weight	0'	20'- 1"	Self Weight	Top	12 lb/ft	-	-	-
Uniform	0'- 2 3/4"	10'- 10 1/2"	FC2 Floor Decking (Plan View Fill)	Top	6 lb/ft	12 lb/ft	-	-
Uniform	0'- 5 1/2"	10'- 10 1/2"	FC2 Floor Decking (Plan View Fill)	Top	7 lb/ft	14 lb/ft	-	-
Uniform	10'- 10 1/2"	20'- 1"	FC2 Floor Decking (Plan View Fill)	Top	9 lb/ft	17 lb/ft	-	-
Uniform	10'- 10 1/2"	19'- 9 1/2"	User Load	Top	60 lb/ft	-	-	-
Point	10'- 8 3/4"	10'- 8 3/4"	B10(i21864)	Front	522 lb	961 lb	-	-
Point	0'- 4 1/8"	0'- 4 1/8"	FC2 Floor Decking (Plan View Fill)	Top	1 lb	2 lb	-	-
Point	19'- 11 1/4"	19'- 11 1/4"	15(i4019)	Top	23 lb	-	7 lb	-

#### UNFACTORED REACTIONS

ID	Start Loc	End Loc	Source	Dead (D)	Live (L)	Snow (S)	Wind (W)
1	0'	0'- 5 1/2"	E5(i3955)	605 lb	685 lb	-	-
2	19'- 9 1/2"	20'- 1"	5(i3966)	932 lb	716 lb	7 lb	-

#### DESIGN NOTES

- The dead loads used in the design of this member were applied to the structure as sloped dead loads.
- Lateral stability factor (KL) was based on user preference to use the width of all plies. (Consult with manufacturer for guideline pertaining to this design option.)
- Analysis and Design has been performed using precision loading from actual modeled conditions. Some loads may have been modified to simplify reporting.
- Tributary Loads have been generated based on actual spacing between members in the model which may differ from the default system spacing. The actual loads applied to the member are shown in the Specified Loads table.
- Transfer reactions may differ from design results as allowed per building codes and standard load distribution practices.
- This report is based on modeled conditions input by the user. Source information for the loads and supports are provided for reference only. Verify that all loads and support conditions are correct.
- Review all loads and reactions to ensure that the member/bearing/connector/structure can resist adequately. Unless already specified on this report, anchorage for uplift reactions to be specified by others. Installation of member and accessories (if required) as per manufacturer's instruction.
- Beam Stability Factor used in the calculation for Allowable Max Pos Moment (KL) = 1.00
- When the applied loads are coming from a member/post/wall above that does not sit directly on this beam, adequate load transfer elements, such as squash blocks, wall studs, or beveled plates are required to transfer the loads to this beam.

#### PLY TO PLY CONNECTION

- Member design assumed proper ply to ply connection by others. Fastener spacing along length of member must not exceed 4 times depth of member. Verify connection between plies according to code specification and follow the manufacturer's installation instruction. Loads assumed to be distributed equally to each ply.



STRUCTURAL COMPONENT ONLY  
DWG # TF24030087





BUILDER: ROYAL PINE HOMES  
SITE: SUMMER RIDGE ESTATES  
MODEL: 2502  
CITY: BRAMPTON

Job Name: 2502  
Level: 2ND FLR FRAMING  
Label: B9 - i21860  
Type: Beam

2 Ply Member  
1 3/4" x 11 7/8" (2.0E 3100)  
WestFraser LVL


Status:  
Design  
Passed

Illustration Not to Scale. Pitch: 0/12

Designed by Single Member Design Engine in MiTek® Structure Version  
8.6.3.353.Update16.11

Report Version: 2021.03.26

03/05/2024 13:44

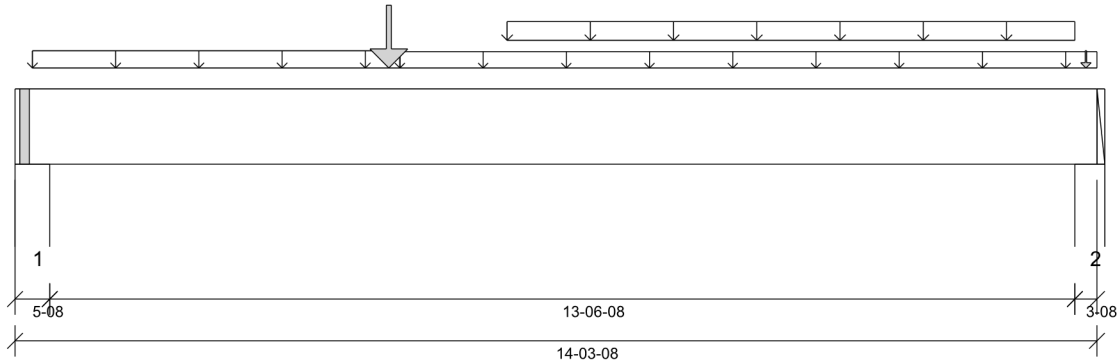

#### DESIGN INFORMATION

Building Code: NBCC 2015, Part9, BCBC 2018, ABC 2019, OBC 2012 (2019 Amendment)  
Design Methodology: LSD  
Service Condition: Dry  
LL Deflection Limit: L/360,  
TL Deflection Limit: L/240,

#### Lateral Restraint Requirements:

Both ends of the member and the outer supports must be laterally restrained. Top and bottom edges of the member must be fully restrained or have the following maximum unbraced length:

Top: 0' Bottom: 8'- 11"

#### Factored Resistance of Support Material:

- 615 psi Wall @ 0'- 4 1/2"
- 615 psi Wall @ 14'- 1"

PLY TO PLY CONNECTION:  
4 ROWS OF 3.25" PNEUMATIC GUN  
NAILS (0.120"x3.25") @ 12" O/C

PLY TO PLY CONNECTION ASSUMES ANY  
SUPPORTED BEAM HANGERS ARE FASTENED  
TO THIS BEAM WITH MIN. 3.5" FASTENERS.



STRUCTURAL COMPONENT ONLY  
DWG # TF24030088

#### ANALYSIS RESULTS

Design Criteria	Location	Load Combination	LDF	Design	Limit	Result
Factored Pos. Moment:	4'- 11 1/4"	1.25D + 1.5L	0.92	5409 lb ft	32668 lb ft	Passed - 17%
Factored Shear:	1'- 5 3/8"	1.25D + 1.5L	0.92	1255 lb	12769 lb	Passed - 10%
Live Load (LL) Pos. Defl.:	6'- 8 1/4"	L		0.057"	L/360	Passed - L/999
Total Load (TL) Pos. Defl.:	6'- 11 1/2"	D + L		0.128"	L/240	Passed - L/999

#### SUPPORT AND REACTION INFORMATION

ID	Input Bearing Length	Controlling Load Combination	LDF	Factored Downward Reaction	Factored Uplift Reaction	Factored Resistance of Member	Factored Resistance of Support	Result
1	5-08	1.25D + 1.5L	0.92	1328 lb		18504 lb	10946 lb	Passed - 12%
2	3-08	1.25D + 1.5S + L	0.78	991 lb		9909 lb	5861 lb	Passed - 17%

#### SPECIFIED LOADS

Type	Start Loc	End Loc	Source	Face	Dead (D)	Live (L)	Snow (S)	Wind (W)
Self Weight	0'	14'- 3 1/2"	Self Weight	Top	12 lb/ft	-	-	-
Uniform	0'- 2 3/4"	5'- 1"	FC2 Floor Decking (Plan View Fill)	Top	10 lb/ft	20 lb/ft	-	-
Uniform	5'- 1"	14'- 3 1/2"	FC2 Floor Decking (Plan View Fill)	Top	5 lb/ft	9 lb/ft	-	-
Uniform	6'- 6"	14'	User Load	Top	60 lb/ft	-	-	-
Point	4'- 11 1/4"	4'- 11 1/4"	B10(i21864)	Back	324 lb	564 lb	-	-
Point	14'- 1 3/4"	14'- 1 3/4"	13(i3994)	Top	23 lb	-	7 lb	-

#### UNFACTORED REACTIONS

ID	Start Loc	End Loc	Source	Dead (D)	Live (L)	Snow (S)	Wind (W)
1	0'	0'- 5 1/2"	35(i10045)	476 lb	478 lb	-	-
2	14'	14'- 3 1/2"	17(i4021)	580 lb	268 lb	7 lb	-

#### DESIGN NOTES

- The dead loads used in the design of this member were applied to the structure as sloped dead loads.
- Lateral stability factor (KL) was based on user preference to use the width of all plies. (Consult with manufacturer for guideline pertaining to this design option.)
- Analysis and Design has been performed using precision loading from actual modeled conditions. Some loads may have been modified to simplify reporting.
- Tributary Loads have been generated based on actual spacing between members in the model which may differ from the default system spacing. The actual loads applied to the member are shown in the Specified Loads table.
- Transfer reactions may differ from design results as allowed per building codes and standard load distribution practices.
- This report is based on modeled conditions input by the user. Source information for the loads and supports are provided for reference only. Verify that all loads and support conditions are correct.
- Review all loads and reactions to ensure that the member/bearing/connector/structure can resist adequately. Unless already specified on this report, anchorage for uplift reactions to be specified by others. Installation of member and accessories (if required) as per manufacturer's instruction.
- Beam Stability Factor used in the calculation for Allowable Max Pos Moment (KL) = 1.00
- When the applied loads are coming from a member/post/wall above that does not sit directly on this beam, adequate load transfer elements, such as squash blocks, wall studs, or beveled plates are required to transfer the loads to this beam.

#### PLY TO PLY CONNECTION

- Member design assumed proper ply to ply connection by others. Fastener spacing along length of member must not exceed 4 times depth of member. Verify connection between plies according to code specification and follow the manufacturer's installation instruction. Loads assumed to be distributed equally to each ply.



BUILDER: ROYAL PINE HOMES  
SITE: SUMMER RIDGE ESTATES  
MODEL: 2502  
CITY: BRAMPTON

Job Name: 2502  
Level: 2ND FLR FRAMING  
Label: B10 - i21864  
Type: Beam


2 Ply Member  
1 3/4" x 11 7/8" (2.0E 3100)  
WestFraser LVL

Status:  
Design  
Passed

Illustration Not to Scale. Pitch: 0/12

Designed by Single Member Design Engine in MiTek® Structure Version  
8.6.3.353.Update16.11

Report Version: 2021.03.26 03/05/2024 13:44

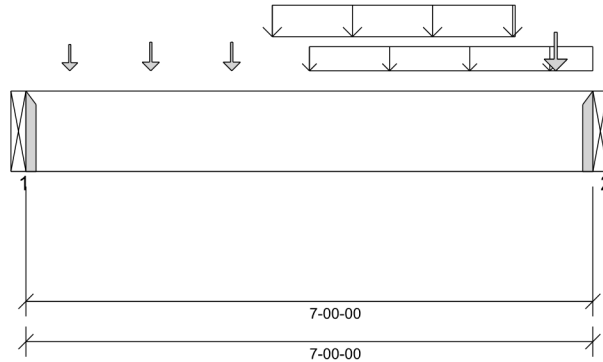

### DESIGN INFORMATION

Building Code: NBCC 2015, Part9, BCBC 2018, ABC 2019, OBC 2012 (2019 Amendment)  
Design Methodology: LSD  
Service Condition: Dry  
LL Deflection Limit: L/360,  
TL Deflection Limit: L/240,

#### Lateral Restraint Requirements:

Both ends of the member and the outer supports must be laterally restrained. Top and bottom edges of the member must be fully restrained or have the following maximum unbraced length:

Top: 0' Bottom: 0'- 9 1/2"

#### Factored Resistance of Support Material:

- 615 psi Beam @ 0'
- 615 psi Beam @ 7'

**PLY TO PLY CONNECTION:**  
4 ROWS OF 3.25" PNEUMATIC GUN  
NAILS (0.120"x3.25") @ 12" O/C

PLY TO PLY CONNECTION ASSUMES ANY  
SUPPORTED BEAM HANGERS ARE FASTENED  
TO THIS BEAM WITH MIN. 3.5" FASTENERS.

### ANALYSIS RESULTS

Design Criteria	Location	Load Combination	LDF	Design	Limit	Result
Factored Pos. Moment:	3'- 11 15/16"	1.25D + 1.5L	1.00	3183 lb ft	35345 lb ft	Passed - 9%
Factored Shear:	6'- 1/8"	1.25D + 1.5L	1.00	1461 lb	13815 lb	Passed - 11%
Live Load (LL) Pos. Defl.:	3'- 7 11/16"	L		0.013"	L/360	Passed - L/999
Total Load (TL) Pos. Defl.:	3'- 7 5/8"	D + L		0.020"	L/240	Passed - L/999

### SUPPORT AND REACTION INFORMATION

ID	Input Bearing Length	Controlling Load Combination	LDF	Factored Downward Reaction	Factored Uplift Reaction	Factored Resistance of Member	Factored Resistance of Support	Result
1	1-08	1.25D + 1.5L	1.00	1248 lb		5460 lb	-	Passed - 23%
2	1-08	1.25D + 1.5L	1.00	2096 lb		5460 lb	-	Passed - 38%

### CONNECTOR INFORMATION

ID	Part No.	Manufacturer	Nailing Requirements			Other Information or Requirement for Reinforcement Accessories		
			Top	Face	Member			
1	HGUS410		-	-	-	Connector manually specified by the user.		
2	HGUS410		-	-	-	Connector manually specified by the user.		

\* Connectors: Refer to manufacturer's specifications, fasteners requirements and installation instruction. Where header fasteners are longer than the width of the supporting member, install backer block or clinch header nails.

### SPECIFIED LOADS

Type	Start Loc	End Loc	Source	Face	Dead (D)	Live (L)	Snow (S)	Wind (W)
Self Weight	0'	7'	Self Weight	Top	12 lb/ft	-	-	-
Uniform	3'- 1/2"	6'- 1/2"	Smoothed Load	Back	108 lb/ft	216 lb/ft	-	-
Uniform	3'- 6"	7'	User Load	Front	60 lb/ft	120 lb/ft	-	-
Point	0'- 6 1/2"	0'- 6 1/2"	J5(i21867)	Back	42 lb	84 lb	-	-
Point	1'- 6 1/2"	1'- 6 1/2"	J5(i21888)	Back	50 lb	100 lb	-	-
Point	2'- 6 1/2"	2'- 6 1/2"	J5(i21878)	Back	50 lb	100 lb	-	-
Point	6'- 6 1/2"	6'- 6 1/2"	J2(i22035)	Back	87 lb	173 lb	-	-

### UNFACTORED REACTIONS

ID	Start Loc	End Loc	Source	Dead (D)	Live (L)	Snow (S)	Wind (W)
1	0'	0'	B9(i21860)	324 lb	564 lb	-	-
2	7'	7'	B8(i21883)	522 lb	961 lb	-	-

### DESIGN NOTES

- The dead loads used in the design of this member were applied to the structure as sloped dead loads.
- Lateral stability factor (KL) was based on user preference to use the width of all plies. (Consult with manufacturer for guideline pertaining to this design option.)
- Analysis and Design has been performed using precision loading from actual modeled conditions. Some loads may have been modified to simplify reporting.
- Tributary Loads have been generated based on actual spacing between members in the model which may differ from the default system spacing. The actual loads applied to the member are shown in the Specified Loads table.
- Transfer reactions may differ from design results as allowed per building codes and standard load distribution practices.
- This report is based on modeled conditions input by the user. Source information for the loads and supports are provided for reference only. Verify that all loads and support conditions are correct.
- Review all loads and reactions to ensure that the member/bearing/connector/structure can resist adequately. Unless already specified on this report, anchorage for uplift reactions to be specified by others. Installation of member and accessories (if required) as per manufacturer's instruction.
- Beam Stability Factor used in the calculation for Allowable Max Pos Moment (KL) = 1.00
- When the applied loads are coming from a member/post/wall above that does not sit directly on this beam, adequate load transfer elements, such as squash blocks, wall studs, or beveled plates are required to transfer the loads to this beam.

### PLY TO PLY CONNECTION

- Member design assumed proper ply to ply connection by others. Fastener spacing along length of member must not exceed 4 times depth of member. Verify connection between plies according to code specification and follow the manufacturer's installation instruction. Loads assumed to be distributed equally to each ply.



STRUCTURAL COMPONENT ONLY  
DWG # TF24030089


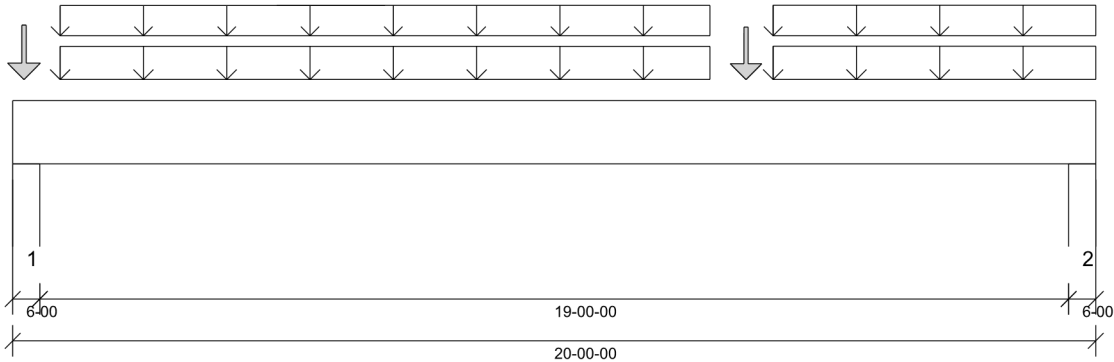
	<b>BUILDER: ROYAL PINE HOMES</b> <b>SITE: SUMMER RIDGE ESTATES</b> <b>MODEL: 2502</b> <b>CITY: BRAMPTON</b>	<b>Job Name: 2502</b> <b>Level: 2ND FLR FRAMING</b> <b>Label: B22 - i21998</b> <b>Type: Beam</b>	<b>3 Ply Member</b> <b>1 3/4" x 14" (2.0E 3100)</b> <b>WestFraser LVL</b>	<b>Status:</b> <b>Design Passed</b>
---	--	---	---	--

Illustration Not to Scale. Pitch: 0/12
 Designed by Single Member Design Engine in MiTek® Structure Version 8.6.3.353.Update16.11
 Report Version: 2021.03.26 03/05/2024 13:44



DESIGN INFORMATION	
Building Code:	NBCC 2015, Part9, BCBC 2018, ABC 2019, OBC 2012 (2019 Amendment)
Design Methodology:	LSD
Service Condition:	Dry
LL Deflection Limit:	L/360,
TL Deflection Limit:	L/240,

**Lateral Restraint Requirements:**

Both ends of the member and the outer supports must be laterally restrained. Top and bottom edges of the member must be fully restrained or have the following maximum unbraced length:

Top: 0' Bottom: 1'- 1 1/2"

**Factored Resistance of Support Material:**

- 812 psi Wall @ 0'- 5"
- 812 psi Wall @ 19'- 7"

**PLY TO PLY CONNECTION:**  
**4 ROWS OF 3.25" PNEUMATIC GUN NAILS (0.120"x3.25") @ 12" O/C**  
 NAIL FROM BOTH FACES (STAGGER 1/2 SPACE)

PLY TO PLY CONNECTION ASSUMES ANY SUPPORTED BEAM HANGERS ARE FASTENED TO THIS BEAM WITH MIN. 3.5" FASTENERS.



STRUCTURAL COMPONENT ONLY  
 DWG # TF24030090

ANALYSIS RESULTS							
Design Criteria	Location	Load Combination	LDF	Design	Limit	Result	
Factored Pos. Moment:	9'- 6 1/2"	1.25D + 1.5L	1.00	41075 lb ft	72216 lb ft	Passed - 57%	
Factored Shear:	1'- 8"	1.25D + 1.5L	1.00	8172 lb	24431 lb	Passed - 33%	
Live Load (LL) Pos. Defl.:	10'- 1/16"	L		0.532"	L/360	Passed - L/428	
Total Load (TL) Pos. Defl.:	10'- 1/16"	D + L		0.825"	L/240	Passed - L/276	
Permanent Deflection:	10'- 1/16"			-	L/360	Passed - L/803	

SUPPORT AND REACTION INFORMATION								
ID	Input Bearing Length	Controlling Load Combination	LDF	Factored Downward Reaction	Factored Uplift Reaction	Factored Resistance of Member	Factored Resistance of Support	Result
1	6-00	1.25D + 1.5L	1.00	9233 lb		32760 lb	25578 lb	Passed - 36%
2	6-00	1.25D + 1.5L	1.00	9012 lb		32760 lb	25578 lb	Passed - 35%

SPECIFIED LOADS								
Type	Start Loc	End Loc	Source	Face	Dead (D)	Live (L)	Snow (S)	Wind (W)
Self Weight	0'	20'	Self Weight	Top	21 lb/ft	-	-	-
Uniform	0'- 10 1/2"	12'- 10 1/2"	Smoothed Load	Back	111 lb/ft	223 lb/ft	-	-
Uniform	14'- 1/2"	20'	Smoothed Load	Back	112 lb/ft	225 lb/ft	-	-
Uniform	14'- 1/2"	20'	Smoothed Load	Front	95 lb/ft	189 lb/ft	-	-
Tapered	0'- 10 1/2"	12'- 10 1/2"	Smoothed Load	Front	93 To 94 lb/ft	187 To 188 lb/ft	-	-
Point	0'- 2 1/2"	0'- 2 1/2"	J3(i21957)	Front	102 lb	204 lb	-	-
Point	13'- 6 1/2"	13'- 6 1/2"	J3(i22007)	Front	109 lb	219 lb	-	-
Point	0'- 2 1/2"	0'- 2 1/2"	J2(i22039)	Back	137 lb	275 lb	-	-
Point	13'- 6 1/2"	13'- 6 1/2"	J2(i22047)	Back	130 lb	260 lb	-	-

UNFACTORED REACTIONS							
ID	Start Loc	End Loc	Source	Dead (D)	Live (L)	Snow (S)	Wind (W)
1	0'	0'- 6"	49(i14829)	2319 lb	4229 lb	-	-
2	19'- 6"	20'	50(i14854)	2263 lb	4116 lb	-	-

**DESIGN NOTES**

- The dead loads used in the design of this member were applied to the structure as sloped dead loads.
- Lateral stability factor (KL) was based on user preference to use the width of all plies. (Consult with manufacturer for guideline pertaining to this design option.)
- Analysis and Design has been performed using precision loading from actual modeled conditions. Some loads may have been modified to simplify reporting.
- Tributary Loads have been generated based on actual spacing between members in the model which may differ from the default system spacing. The actual loads applied to the member are shown in the Specified Loads table.
- Transfer reactions may differ from design results as allowed per building codes and standard load distribution practices.
- This report is based on modeled conditions input by the user. Source information for the loads and supports are provided for reference only. Verify that all loads and support conditions are correct.
- Review all loads and reactions to ensure that the member/bearing/connector/structure can resist adequately. Unless already specified on this report, anchorage for uplift reactions to be specified by others. Installation of member and accessories (if required) as per manufacturer's instruction.
- Beam Stability Factor used in the calculation for Allowable Max Pos Moment (KL) = 1.00
- When the applied loads are coming from a member/post/wall above that does not sit directly on this beam, adequate load transfer elements, such as squash blocks, wall studs, or beveled plates are required to transfer the loads to this beam.

**PLY TO PLY CONNECTION**

- Member design assumed proper ply to ply connection by others. Fastener spacing along length of member must not exceed 4 times depth of member. Verify connection between plies according to code specification and follow the manufacturer's installation instruction. Loads assumed to be distributed equally to each ply.



BUILDER: ROYAL PINE HOMES  
SITE: SUMMER RIDGE ESTATES  
MODEL: 2502  
CITY: BRAMPTON

Job Name: 2502  
Level: 2ND FLR FRAMING  
Label: B26 - i21960  
Type: Beam

3 Ply Member  
1 3/4" x 11 7/8" (2.0E 3100)  
WestFraser LVL


Status:  
Design  
Passed

Illustration Not to Scale. Pitch: 0/12

Designed by Single Member Design Engine in MiTek® Structure Version  
8.6.3.353.Update16.11

Report Version: 2021.03.26

03/05/2024 13:44

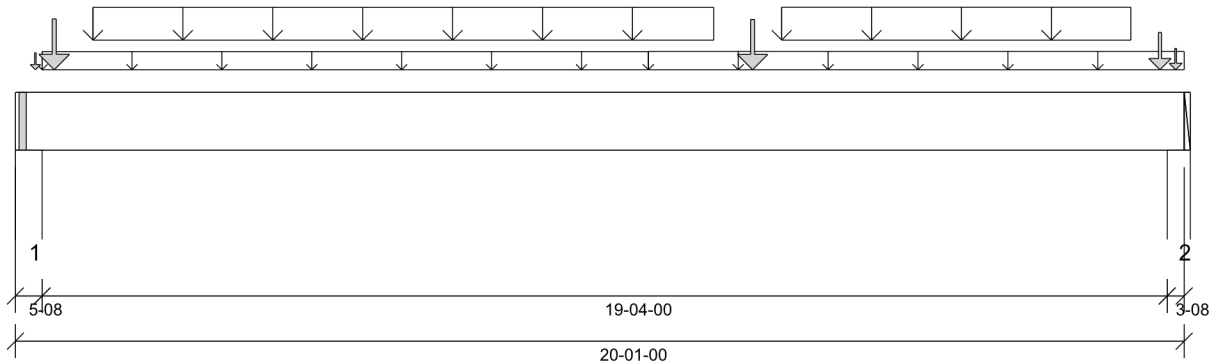

### DESIGN INFORMATION

Building Code: NBCC 2015, Part9, BCBC 2018, ABC 2019, OBC 2012 (2019 Amendment)  
Design Methodology: LSD  
Service Condition: Dry  
LL Deflection Limit: L/360,  
TL Deflection Limit: L/240,

#### Lateral Restraint Requirements:

Both ends of the member and the outer supports must be laterally restrained. Top and bottom edges of the member must be fully restrained or have the following maximum unbraced length:

Top: 0' Bottom: 1'- 1 1/2"

#### Factored Resistance of Support Material:

- 615 psi Wall @ 0'- 4 1/2"
- 615 psi Wall @ 19'- 10 1/2"

#### PLY TO PLY CONNECTION:

4 ROWS OF 3.25" PNEUMATIC GUN NAILS (0.120"x3.25") @ 12" O/C  
NAIL FROM BOTH FACES (STAGGER 1/2 SPACE)

PLY TO PLY CONNECTION ASSUMES ANY SUPPORTED BEAM HANGERS ARE FASTENED TO THIS BEAM WITH MIN. 3.5" FASTENERS.

### ANALYSIS RESULTS

Design Criteria	Location	Load Combination	LDF	Design	Limit	Result
Factored Pos. Moment:	10'	1.25D + 1.5L	1.00	21599 lb ft	53017 lb ft	Passed - 41%
Factored Shear:	1'- 5 3/8"	1.25D + 1.5L	1.00	4446 lb	20723 lb	Passed - 21%
Live Load (LL) Pos. Defl.:	10'- 1 9/16"	L		0.464"	L/360	Passed - L/499
Total Load (TL) Pos. Defl.:	10'- 1 9/16"	D + L		0.737"	L/240	Passed - L/314
Permanent Deflection:	10'- 1 9/16"			-	L/360	Passed - L/877

### SUPPORT AND REACTION INFORMATION

ID	Input Bearing Length	Controlling Load Combination	LDF	Factored Downward Reaction	Factored Uplift Reaction	Factored Resistance of Member	Factored Resistance of Support	Result
1	5-08	1.25D + 1.5L	1.00	4511 lb		30031 lb	17764 lb	Passed - 25%
2	3-08	1.25D + 1.5L + S	1.00	4517 lb		19110 lb	11305 lb	Passed - 40%

### SPECIFIED LOADS

Type	Start Loc	End Loc	Source	Face	Dead (D)	Live (L)	Snow (S)	Wind (W)
Self Weight	0'	20'- 1"	Self Weight	Top	18 lb/ft	-	-	-
Uniform	0'- 5 1/2"	10'- 10 1/2"	FC2 Floor Decking (Plan View Fill)	Top	7 lb/ft	14 lb/ft	-	-
Uniform	1'- 4"	12'	Smoothed Load	Back	94 lb/ft	188 lb/ft	-	-
Uniform	10'- 10 1/2"	20'- 1"	FC2 Floor Decking (Plan View Fill)	Top	9 lb/ft	17 lb/ft	-	-
Uniform	13'- 2"	19'- 2"	Smoothed Load	Back	94 lb/ft	188 lb/ft	-	-
Point	0'- 8"	0'- 8"	J3(i21956)	Back	111 lb	223 lb	-	-
Point	12'- 8"	12'- 8"	J3(i22007)	Back	109 lb	219 lb	-	-
Point	19'- 8"	19'- 8"	J3(i21951)	Back	67 lb	134 lb	-	-
Point	0'- 4 1/8"	0'- 4 1/8"	FC2 Floor Decking (Plan View Fill)	Top	1 lb	2 lb	-	-
Point	19'- 11 1/4"	19'- 11 1/4"	15(i4019)	Top	35 lb	-	10 lb	-

### UNFACTORED REACTIONS

ID	Start Loc	End Loc	Source	Dead (D)	Live (L)	Snow (S)	Wind (W)
1	0'	0'- 5 1/2"	-	1189 lb	2020 lb	-	-
+++	0'- 1/2"	0'- 1/2"	E54(i10044)	227 lb	385 lb	-	-
+++	0'- 2 1/4"	0'- 2 1/4"	E5(i3955)	962 lb	1635 lb	-	-
2	19'- 9 1/2"	20'- 1"	5(i3966)	1209 lb	1995 lb	10 lb	-


### DESIGN NOTES

- CAUTION: One or more plies are not supported properly at 2-12. At least 75% of every ply must be contacting support.
- CAUTION: One or more plies are not supported properly at 2-12. At least 75% of every ply must be contacting support.
- The dead loads used in the design of this member were applied to the structure as sloped dead loads.
- Lateral stability factor (KL) was based on user preference to use the width of all plies. (Consult with manufacturer for guideline pertaining to this design option.)
- Analysis and Design has been performed using precision loading from actual modeled conditions. Some loads may have been modified to simplify reporting.
- Tributary Loads have been generated based on actual spacing between members in the model which may differ from the default system spacing. The actual loads applied to the member are shown in the Specified Loads table.
- Transfer reactions may differ from design results as allowed per building codes and standard load distribution practices.
- This report is based on modeled conditions input by the user. Source information for the loads and supports are provided for reference only. Verify that all loads and support conditions are correct.
- Review all loads and reactions to ensure that the member/bearing/connector/structure can resist adequately. Unless already specified on this report, anchorage for uplift reactions to be specified by others. Installation of member and accessories (if required) as per manufacturer's instruction.
- Beam Stability Factor used in the calculation for Allowable Max Pos Moment (KL) = 1.00
- When the applied loads are coming from a member/post/wall above that does not sit directly on this beam, adequate load transfer elements, such as squash blocks, wall studs, or beveled plates are required to transfer the loads to this beam.
- Bearing length at support 1 was calculated based on the actual bearing area divided by the supported member width and may not match expected value when bearing is not rectangular or when the supported member is not supported by its full width.



STRUCTURAL COMPONENT ONLY  
DWG # TF24030091 PG 1/2



	BUILDER:	ROYAL PINE HOMES	Job Name:	2502	3 Ply Member 1 3/4" x 11 7/8" (2.0E 3100) WestFraser LVL	Status: Design Passed
	SITE:	SUMMER RIDGE ESTATES	Level:	2ND FLR FRAMING		
	MODEL:	2502	Label:	B26 - i21960		
	CITY:	BRAMPTON	Type:	Beam		


- One or more plies are not properly supported at 1. Verify with structural engineer or EWP manufacturer if this condition is acceptable.

PLY TO PLY CONNECTION

- Member design assumed proper ply to ply connection by others. Fastener spacing along length of member must not exceed 4 times depth of member. Verify connection between plies according to code specification and follow the manufacturer's installation instruction. Loads assumed to be distributed equally to each ply.





7c

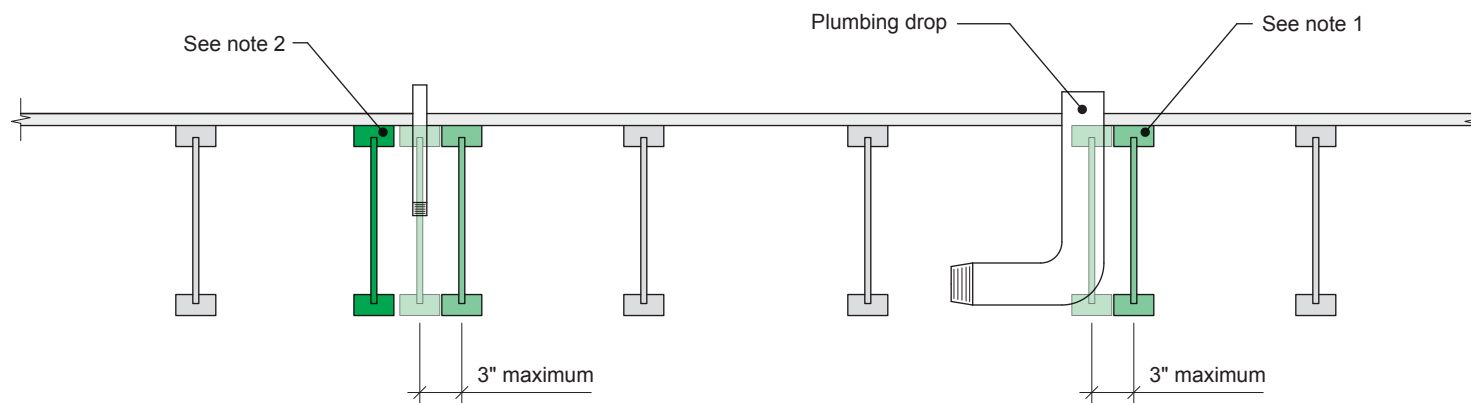**Notes:**

1. To prevent interference with plumbing, a joist may be shifted up to 3 inches if the edge of the floor panel is supported and the span rating is not exceeded.
2. In all other cases, an additional joist is required.

All nails shown in the details are assumed to be common nails unless otherwise noted. Nails shall have a diameter not less than 0.128 inch for 2-1/2-inch nails, or 0.144 inch for 3-inch nails. Individual components not shown to scale for clarity.

7d

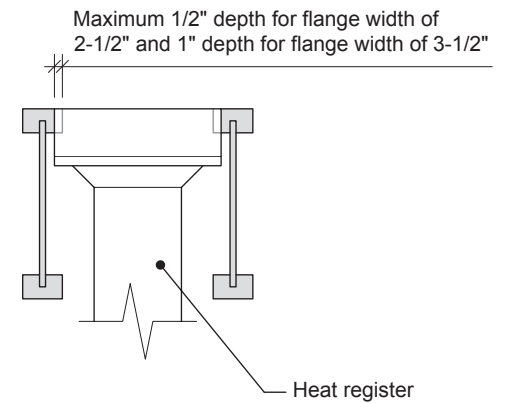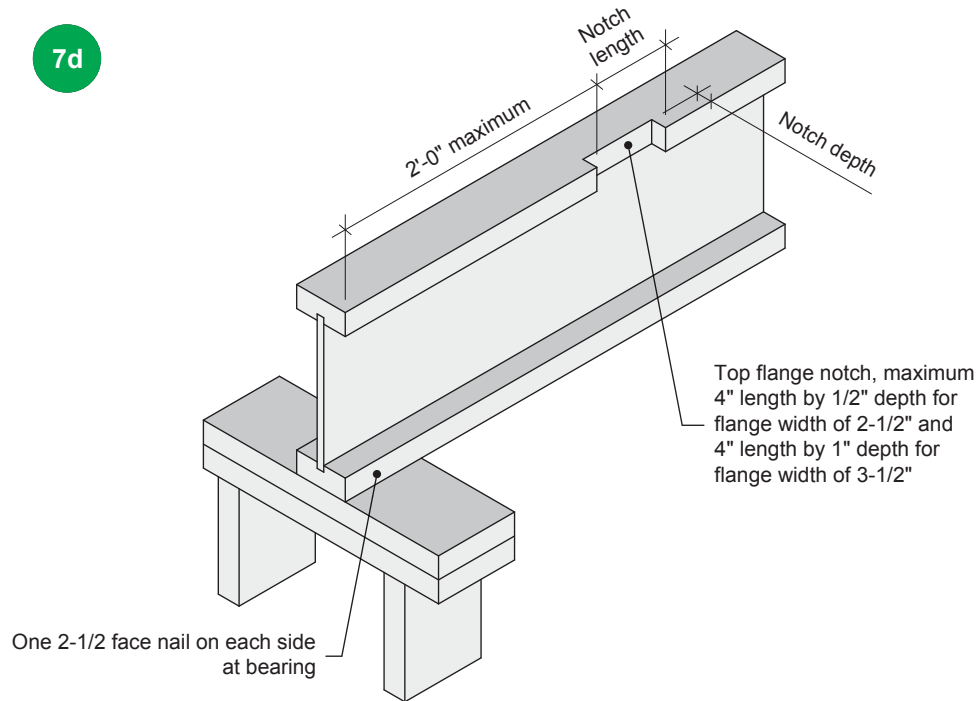

**Notes:**

1. Blocking required at bearing for lateral support, not shown for clarity.
2. The maximum dimensions for a notch on the side of the top flange are 4-inch length by 1/2-inch depth for flange width of 2-1/2 inches, and 4-inch length by 1-inch depth for flange width of 3-1/2 inches.
3. This detail applies to simple-span joists and multiple-span joists where the notch is located at the end half-span.
4. For other applications, contact Nordic Structures.

All nails shown in the details are assumed to be common nails unless otherwise noted. Nails shall have a diameter not less than 0.128 inch for 2-1/2-inch nails, or 0.144 inch for 3-inch nails. Individual components not shown to scale for clarity.

### Maximum Floor Spans – S2.1

#### Design Criteria

Spans:	Simple span
Loads:	Live load = 40 psf and dead load = 15 psf
Deflection limits:	L/480 under live load and L/240 under total load
Sheathing:	5/8 in. nailed-glued oriented strand board (OSB) sheathing

#### Maximum Floor Spans

Joist depth	Joist series	Bare On centre spacing				1/2 in. gypsum ceiling On centre spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-1"	14'-3"	13'-10"	-	15'-7"	14'-9"	14'-3"	-
	NI-40x	16'-2"	15'-3"	14'-8"	-	16'-7"	15'-8"	15'-1"	-
	NI-60	16'-4"	15'-4"	14'-10"	-	16'-9"	15'-9"	15'-3"	-
	NI-80	17'-3"	16'-3"	15'-8"	-	17'-8"	16'-7"	16'-0"	-
11-7/8"	NI-20	17'-0"	16'-0"	15'-6"	-	17'-6"	16'-7"	16'-0"	-
	NI-40x	18'-2"	17'-1"	16'-6"	-	18'-9"	17'-6"	16'-11"	-
	NI-60	18'-5"	17'-3"	16'-8"	-	19'-0"	17'-8"	17'-1"	-
	NI-80	19'-9"	18'-3"	17'-7"	-	20'-4"	18'-10"	18'-0"	-
	NI-90	20'-2"	18'-8"	17'-10"	-	20'-9"	19'-2"	18'-4"	-
14"	NI-40x	20'-1"	18'-8"	17'-10"	-	20'-10"	19'-4"	18'-6"	-
	NI-60	20'-6"	18'-11"	18'-2"	-	21'-2"	19'-8"	18'-9"	-
	NI-80	21'-11"	20'-3"	19'-4"	-	22'-7"	20'-11"	20'-0"	-
	NI-90	22'-5"	20'-8"	19'-9"	-	23'-0"	21'-4"	20'-4"	-
16"	NI-60	22'-4"	20'-8"	19'-9"	-	23'-1"	21'-5"	20'-6"	-
	NI-80	23'-11"	22'-1"	21'-1"	-	24'-8"	22'-10"	21'-9"	-
	NI-90	24'-5"	22'-6"	21'-6"	-	25'-1"	23'-2"	22'-2"	-

Joist depth	Joist series	Mid-span blocking with 1x4 inch strap On centre spacing				Mid-span blocking and 1/2 in. gypsum ceiling On centre spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-8"	15'-3"	14'-5"	-	16'-8"	15'-3"	14'-5"	-
	NI-40x	17'-11"	17'-0"	16'-1"	-	18'-5"	17'-1"	16'-1"	-
	NI-60	18'-2"	17'-1"	16'-4"	-	18'-8"	17'-4"	16'-4"	-
	NI-80	19'-5"	18'-0"	17'-5"	-	19'-10"	18'-5"	17'-8"	-
11-7/8"	NI-20	19'-7"	18'-2"	17'-3"	-	19'-11"	18'-3"	17'-3"	-
	NI-40x	21'-1"	19'-7"	18'-8"	-	21'-8"	20'-2"	19'-2"	-
	NI-60	21'-4"	19'-9"	18'-11"	-	21'-11"	20'-5"	19'-6"	-
	NI-80	22'-9"	21'-1"	20'-2"	-	23'-3"	21'-8"	20'-8"	-
	NI-90	23'-3"	21'-6"	20'-6"	-	23'-9"	22'-0"	21'-0"	-
14"	NI-40x	23'-8"	21'-11"	20'-11"	-	24'-4"	22'-8"	21'-8"	-
	NI-60	24'-0"	22'-3"	21'-3"	-	24'-8"	22'-11"	21'-11"	-
	NI-80	25'-7"	23'-9"	22'-7"	-	26'-2"	24'-4"	23'-3"	-
	NI-90	26'-1"	24'-2"	23'-0"	-	26'-8"	24'-9"	23'-7"	-
16"	NI-60	26'-5"	24'-6"	23'-5"	-	27'-2"	25'-3"	24'-2"	-
	NI-80	28'-2"	26'-1"	24'-10"	-	28'-10"	26'-9"	25'-6"	-
	NI-90	28'-8"	26'-6"	25'-3"	-	29'-3"	27'-2"	25'-11"	-

#### Notes:

1. The tabulated clear spans are based on CSA O86-14 and NBC 2015, and are applicable to residential floor construction meeting the above design criteria.
2. For multiple-span applications, the end spans shall be 40% or more of the adjacent span.
3. Minimum bearing length shall be 1-3/4 inch for end bearings, and 3-1/2 inches for intermediate bearings.
4. Bearing stiffeners are not required when I-joists are used in accordance with this table, except as required for hangers.
5. Nordic I-joists are listed in CCMC Evaluation Report 13032-R and APA Product Report PR-L274C.



## Maximum Floor Spans – S4.1

### Design Criteria

Spans:	Simple span
Loads:	Live load = 40 psf and dead load = 15 psf
Deflection limits:	L/480 under live load and L/240 under total load
Sheathing:	3/4 in. nailed-glued oriented strand board (OSB) sheathing

### Maximum Floor Spans

Joist depth	Joist series	Bare On centre spacing				1/2 in. gypsum ceiling On centre spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-11"	15'-0"	14'-6"	13'-5"	16'-5"	15'-5"	14'-6"	13'-5"
	NI-40x	17'-0"	16'-0"	15'-5"	14'-10"	17'-5"	16'-5"	15'-10"	15'-2"
	NI-60	17'-2"	16'-2"	15'-7"	14'-11"	17'-7"	16'-7"	16'-0"	15'-4"
	NI-80	18'-3"	17'-1"	16'-5"	15'-9"	18'-8"	17'-5"	16'-9"	16'-1"
11-7/8"	NI-20	17'-11"	16'-11"	16'-3"	15'-8"	18'-7"	17'-5"	16'-10"	16'-2"
	NI-40x	19'-4"	17'-11"	17'-3"	16'-7"	19'-11"	18'-6"	17'-9"	17'-0"
	NI-60	19'-7"	18'-2"	17'-6"	16'-9"	20'-2"	18'-9"	17'-11"	17'-2"
	NI-80	21'-1"	19'-6"	18'-6"	17'-7"	21'-7"	20'-0"	19'-0"	18'-0"
	NI-90	21'-6"	19'-10"	18'-11"	17'-11"	22'-0"	20'-4"	19'-5"	18'-4"
14"	NI-40x	21'-5"	19'-11"	18'-11"	18'-0"	22'-1"	20'-7"	19'-7"	18'-7"
	NI-60	21'-10"	20'-2"	19'-3"	18'-3"	22'-6"	20'-10"	19'-11"	18'-10"
	NI-80	23'-5"	21'-7"	20'-7"	19'-5"	24'-0"	22'-3"	21'-2"	20'-0"
	NI-90	23'-10"	22'-1"	21'-0"	19'-10"	24'-5"	22'-7"	21'-6"	20'-4"
16"	NI-60	23'-9"	22'-0"	21'-0"	19'-10"	24'-6"	22'-9"	21'-8"	20'-7"
	NI-80	25'-6"	23'-7"	22'-5"	21'-2"	26'-2"	24'-3"	23'-1"	21'-10"
	NI-90	26'-0"	24'-0"	22'-10"	21'-6"	26'-7"	24'-8"	23'-5"	22'-2"

Joist depth	Joist series	Mid-span blocking with 1x4 inch strap On centre spacing				Mid-span blocking and 1/2 in. gypsum ceiling On centre spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-10"	15'-5"	14'-6"	13'-5"	16'-10"	15'-5"	14'-6"	13'-5"
	NI-40x	18'-8"	17'-2"	16'-3"	15'-2"	18'-10"	17'-2"	16'-3"	15'-2"
	NI-60	18'-11"	17'-6"	16'-6"	15'-5"	19'-2"	17'-6"	16'-6"	15'-5"
	NI-80	20'-3"	18'-10"	17'-11"	16'-10"	20'-8"	19'-3"	18'-2"	16'-10"
11-7/8"	NI-20	20'-1"	18'-5"	17'-5"	16'-2"	20'-1"	18'-5"	17'-5"	16'-2"
	NI-40x	21'-10"	20'-4"	19'-4"	17'-8"	22'-5"	20'-6"	19'-4"	17'-8"
	NI-60	22'-1"	20'-7"	19'-8"	18'-4"	22'-8"	20'-10"	19'-8"	18'-4"
	NI-80	23'-8"	22'-0"	20'-11"	19'-10"	24'-1"	22'-6"	21'-6"	20'-0"
	NI-90	24'-1"	22'-5"	21'-4"	20'-2"	24'-7"	22'-11"	21'-10"	20'-7"
14"	NI-40x	24'-5"	22'-9"	21'-9"	19'-5"	25'-1"	23'-2"	21'-9"	19'-5"
	NI-60	24'-10"	23'-2"	22'-1"	20'-10"	25'-6"	23'-8"	22'-4"	20'-10"
	NI-80	26'-6"	24'-8"	23'-6"	22'-2"	27'-1"	25'-3"	24'-1"	22'-9"
	NI-90	27'-0"	25'-1"	23'-11"	22'-7"	27'-6"	25'-8"	24'-6"	23'-2"
16"	NI-60	27'-3"	25'-5"	24'-3"	22'-11"	28'-0"	26'-2"	24'-9"	23'-1"
	NI-80	29'-1"	27'-1"	25'-9"	24'-4"	29'-8"	27'-9"	26'-5"	25'-0"
	NI-90	29'-7"	27'-6"	26'-2"	24'-9"	30'-2"	28'-2"	26'-10"	25'-5"

### Notes:

1. The tabulated clear spans are based on CSA O86-14 and NBC 2015, and are applicable to residential floor construction meeting the above design criteria.
2. For multiple-span applications, the end spans shall be 40% or more of the adjacent span.
3. Minimum bearing length shall be 1-3/4 inch for end bearings, and 3-1/2 inches for intermediate bearings.
4. Bearing stiffeners are not required when I-joists are used in accordance with this table, except as required for hangers.
5. Nordic I-joists are listed in CCMC Evaluation Report 13032-R and APA Product Report PR-L274C.

### Maximum Floor Spans – S6.1

#### Design Criteria

Spans:	Simple span
Loads:	Live load = 40 psf and dead load = 15 psf
Deflection limits:	L/480 under live load and L/240 under total load
Sheathing:	5/8 in. nailed-glued Canadian softwood plywood

#### Maximum Floor Spans

Joist depth	Joist series	Bare On centre spacing				1/2 in. gypsum ceiling On centre spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	14'-11"	14'-1"	13'-7"	-	15'-4"	14'-6"	14'-1"	-
	NI-40x	15'-11"	15'-0"	14'-6"	-	16'-4"	15'-5"	14'-11"	-
	NI-60	16'-1"	15'-2"	14'-8"	-	16'-6"	15'-7"	15'-1"	-
	NI-80	17'-1"	16'-1"	15'-6"	-	17'-5"	16'-5"	15'-10"	-
11-7/8"	NI-20	16'-9"	15'-10"	15'-4"	-	17'-4"	16'-4"	15'-10"	-
	NI-40x	17'-10"	16'-10"	16'-3"	-	18'-6"	17'-4"	16'-9"	-
	NI-60	18'-1"	17'-0"	16'-5"	-	18'-9"	17'-6"	16'-11"	-
	NI-80	19'-6"	18'-0"	17'-4"	-	20'-1"	18'-7"	17'-9"	-
	NI-90	19'-11"	18'-4"	17'-8"	-	20'-5"	18'-11"	18'-1"	-
14"	NI-40x	19'-10"	18'-4"	17'-8"	-	20'-6"	19'-1"	18'-3"	-
	NI-60	20'-2"	18'-8"	17'-11"	-	20'-10"	19'-4"	18'-6"	-
	NI-80	21'-8"	20'-0"	19'-1"	-	22'-4"	20'-8"	19'-9"	-
	NI-90	22'-1"	20'-5"	19'-6"	-	22'-9"	21'-0"	20'-1"	-
16"	NI-60	22'-0"	20'-4"	19'-6"	-	22'-9"	21'-1"	20'-2"	-
	NI-80	23'-7"	21'-10"	20'-10"	-	24'-4"	22'-6"	21'-6"	-
	NI-90	24'-1"	22'-2"	21'-2"	-	24'-9"	22'-11"	21'-10"	-

Joist depth	Joist series	Mid-span blocking with 1x4 inch strap On centre spacing				Mid-span blocking and 1/2 in. gypsum ceiling On centre spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-6"	15'-1"	14'-3"	-	16'-6"	15'-1"	14'-3"	-
	NI-40x	17'-9"	16'-10"	15'-11"	-	18'-2"	16'-11"	15'-11"	-
	NI-60	17'-11"	16'-11"	16'-2"	-	18'-5"	17'-2"	16'-2"	-
	NI-80	19'-3"	17'-10"	17'-3"	-	19'-8"	18'-3"	17'-7"	-
11-7/8"	NI-20	19'-4"	18'-0"	17'-1"	-	19'-9"	18'-1"	17'-1"	-
	NI-40x	20'-10"	19'-4"	18'-6"	-	21'-5"	19'-11"	19'-0"	-
	NI-60	21'-1"	19'-7"	18'-8"	-	21'-8"	20'-2"	19'-3"	-
	NI-80	22'-6"	20'-10"	19'-11"	-	23'-1"	21'-5"	20'-5"	-
	NI-90	23'-0"	21'-3"	20'-4"	-	23'-6"	21'-10"	20'-10"	-
14"	NI-40x	23'-5"	21'-8"	20'-9"	-	24'-0"	22'-5"	21'-5"	-
	NI-60	23'-9"	22'-0"	21'-0"	-	24'-5"	22'-8"	21'-8"	-
	NI-80	25'-4"	23'-6"	22'-5"	-	25'-11"	24'-1"	23'-0"	-
	NI-90	25'-10"	23'-11"	22'-9"	-	26'-5"	24'-6"	23'-4"	-
16"	NI-60	26'-2"	24'-3"	23'-2"	-	26'-11"	25'-0"	23'-11"	-
	NI-80	27'-11"	25'-10"	24'-7"	-	28'-7"	26'-6"	25'-3"	-
	NI-90	28'-5"	26'-3"	25'-0"	-	29'-0"	26'-11"	25'-8"	-

#### Notes:

1. The tabulated clear spans are based on CSA O86-14 and NBC 2015, and are applicable to residential floor construction meeting the above design criteria.
2. For multiple-span applications, the end spans shall be 40% or more of the adjacent span.
3. Minimum bearing length shall be 1-3/4 inch for end bearings, and 3-1/2 inches for intermediate bearings.
4. Bearing stiffeners are not required when I-joists are used in accordance with this table, except as required for hangers.
5. Nordic I-joists are listed in CCMC Evaluation Report 13032-R and APA Product Report PR-L274C.

## Maximum Floor Spans – S7.1

### Design Criteria

Spans:	Simple span
Loads:	Live load = 40 psf and dead load = 15 psf
Deflection limits:	L/480 under live load and L/240 under total load
Sheathing:	3/4 in. nailed-glued Canadian softwood plywood

### Maximum Floor Spans

Joist depth	Joist series	Bare On centre spacing				1/2 in. gypsum ceiling On centre spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-10"	15'-0"	14'-5"	13'-5"	16'-4"	15'-5"	14'-6"	13'-5"
	NI-40x	16'-11"	15'-11"	15'-4"	14'-9"	17'-4"	16'-4"	15'-9"	15'-1"
	NI-60	17'-1"	16'-1"	15'-6"	14'-10"	17'-6"	16'-6"	15'-11"	15'-3"
	NI-80	18'-1"	17'-0"	16'-4"	15'-8"	18'-7"	17'-4"	16'-8"	16'-0"
11-7/8"	NI-20	17'-10"	16'-10"	16'-2"	15'-7"	18'-5"	17'-4"	16'-9"	16'-1"
	NI-40x	19'-3"	17'-10"	17'-2"	16'-6"	19'-10"	18'-5"	17'-8"	16'-11"
	NI-60	19'-6"	18'-1"	17'-4"	16'-8"	20'-1"	18'-8"	17'-10"	17'-1"
	NI-80	20'-11"	19'-4"	18'-5"	17'-7"	21'-5"	19'-10"	18'-11"	17'-11"
	NI-90	21'-4"	19'-9"	18'-9"	17'-10"	21'-10"	20'-3"	19'-3"	18'-3"
14"	NI-40x	21'-4"	19'-9"	18'-10"	17'-11"	22'-0"	20'-5"	19'-6"	18'-6"
	NI-60	21'-8"	20'-1"	19'-2"	18'-2"	22'-4"	20'-9"	19'-9"	18'-9"
	NI-80	23'-3"	21'-6"	20'-5"	19'-4"	23'-10"	22'-1"	21'-0"	19'-11"
	NI-90	23'-9"	21'-11"	20'-10"	19'-8"	24'-3"	22'-6"	21'-5"	20'-3"
16"	NI-60	23'-7"	21'-10"	20'-10"	19'-9"	24'-4"	22'-7"	21'-7"	20'-5"
	NI-80	25'-4"	23'-5"	22'-3"	21'-1"	26'-0"	24'-1"	22'-11"	21'-8"
	NI-90	25'-10"	23'-10"	22'-8"	21'-5"	26'-5"	24'-6"	23'-4"	22'-0"

Joist depth	Joist series	Mid-span blocking with 1x4 inch strap On centre spacing				Mid-span blocking and 1/2 in. gypsum ceiling On centre spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-10"	15'-5"	14'-6"	13'-5"	16'-10"	15'-5"	14'-6"	13'-5"
	NI-40x	18'-7"	17'-2"	16'-3"	15'-2"	18'-10"	17'-2"	16'-3"	15'-2"
	NI-60	18'-10"	17'-6"	16'-6"	15'-5"	19'-1"	17'-6"	16'-6"	15'-5"
	NI-80	20'-2"	18'-9"	17'-11"	16'-10"	20'-7"	19'-2"	18'-2"	16'-10"
11-7/8"	NI-20	20'-1"	18'-5"	17'-5"	16'-2"	20'-1"	18'-5"	17'-5"	16'-2"
	NI-40x	21'-9"	20'-3"	19'-4"	17'-8"	22'-4"	20'-5"	19'-4"	17'-8"
	NI-60	22'-0"	20'-6"	19'-7"	18'-4"	22'-7"	20'-10"	19'-8"	18'-4"
	NI-80	23'-6"	21'-10"	20'-10"	19'-9"	24'-0"	22'-5"	21'-4"	20'-0"
	NI-90	24'-0"	22'-4"	21'-3"	20'-1"	24'-6"	22'-10"	21'-9"	20'-7"
14"	NI-40x	24'-4"	22'-8"	21'-8"	19'-5"	25'-0"	23'-2"	21'-9"	19'-5"
	NI-60	24'-9"	23'-0"	22'-0"	20'-9"	25'-5"	23'-8"	22'-4"	20'-10"
	NI-80	26'-5"	24'-6"	23'-4"	22'-1"	27'-0"	25'-2"	24'-0"	22'-8"
	NI-90	26'-11"	25'-0"	23'-10"	22'-6"	27'-5"	25'-7"	24'-5"	23'-1"
16"	NI-60	27'-2"	25'-4"	24'-2"	22'-10"	27'-11"	26'-1"	24'-9"	23'-1"
	NI-80	29'-0"	26'-11"	25'-8"	24'-3"	29'-7"	27'-7"	26'-4"	24'-11"
	NI-90	29'-6"	27'-5"	26'-1"	24'-8"	30'-1"	28'-1"	26'-9"	25'-4"

### Notes:

1. The tabulated clear spans are based on CSA O86-14 and NBC 2015, and are applicable to residential floor construction meeting the above design criteria.
2. For multiple-span applications, the end spans shall be 40% or more of the adjacent span.
3. Minimum bearing length shall be 1-3/4 inch for end bearings, and 3-1/2 inches for intermediate bearings.
4. Bearing stiffeners are not required when I-joists are used in accordance with this table, except as required for hangers.
5. Nordic I-joists are listed in CCMC Evaluation Report 13032-R and APA Product Report PR-L274C.

### Maximum Floor Spans – M2.1

#### Design Criteria

Spans:	Simple span
Loads:	Live load = 40 psf and dead load = 20 psf
Deflection limits:	L/480 under live load and L/240 under total load
Sheathing:	5/8 in. nailed-glued oriented strand board (OSB) sheathing

#### Maximum Floor Spans

Joist depth	Joist series	Bare On centre spacing				1/2 in. gypsum ceiling On centre spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-1"	14'-3"	13'-10"	-	15'-7"	14'-9"	14'-3"	-
	NI-40x	16'-2"	15'-3"	14'-8"	-	16'-7"	15'-8"	15'-1"	-
	NI-60	16'-4"	15'-4"	14'-10"	-	16'-9"	15'-9"	15'-3"	-
	NI-80	17'-3"	16'-3"	15'-8"	-	17'-8"	16'-7"	16'-0"	-
11-7/8"	NI-20	17'-0"	16'-0"	15'-6"	-	17'-6"	16'-7"	16'-0"	-
	NI-40x	18'-2"	17'-1"	16'-6"	-	18'-9"	17'-6"	16'-11"	-
	NI-60	18'-5"	17'-3"	16'-8"	-	19'-0"	17'-8"	17'-1"	-
	NI-80	19'-9"	18'-3"	17'-7"	-	20'-4"	18'-10"	18'-0"	-
	NI-90	20'-2"	18'-8"	17'-10"	-	20'-9"	19'-2"	18'-4"	-
14"	NI-40x	20'-1"	18'-8"	17'-10"	-	20'-10"	19'-4"	18'-6"	-
	NI-60	20'-6"	18'-11"	18'-2"	-	21'-2"	19'-8"	18'-9"	-
	NI-80	21'-11"	20'-3"	19'-4"	-	22'-7"	20'-11"	20'-0"	-
	NI-90	22'-5"	20'-8"	19'-9"	-	23'-0"	21'-4"	20'-4"	-
16"	NI-60	22'-4"	20'-8"	19'-9"	-	23'-1"	21'-5"	20'-6"	-
	NI-80	23'-11"	22'-1"	21'-1"	-	24'-8"	22'-10"	21'-9"	-
	NI-90	24'-5"	22'-6"	21'-6"	-	25'-1"	23'-2"	22'-2"	-

Joist depth	Joist series	Mid-span blocking with 1x4 inch strap On centre spacing				Mid-span blocking and 1/2 in. gypsum ceiling On centre spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-8"	15'-3"	14'-5"	-	16'-8"	15'-3"	14'-5"	-
	NI-40x	17'-11"	17'-0"	16'-1"	-	18'-5"	17'-1"	16'-1"	-
	NI-60	18'-2"	17'-1"	16'-4"	-	18'-8"	17'-4"	16'-4"	-
	NI-80	19'-5"	18'-0"	17'-5"	-	19'-10"	18'-5"	17'-8"	-
11-7/8"	NI-20	19'-7"	18'-2"	17'-3"	-	19'-11"	18'-3"	17'-3"	-
	NI-40x	21'-1"	19'-7"	18'-8"	-	21'-8"	20'-2"	19'-0"	-
	NI-60	21'-4"	19'-9"	18'-11"	-	21'-11"	20'-5"	19'-6"	-
	NI-80	22'-9"	21'-1"	20'-2"	-	23'-3"	21'-8"	20'-8"	-
	NI-90	23'-3"	21'-6"	20'-6"	-	23'-9"	22'-0"	21'-0"	-
14"	NI-40x	23'-8"	21'-11"	20'-11"	-	24'-4"	22'-8"	20'-11"	-
	NI-60	24'-0"	22'-3"	21'-3"	-	24'-8"	22'-11"	21'-11"	-
	NI-80	25'-7"	23'-9"	22'-7"	-	26'-2"	24'-4"	23'-3"	-
	NI-90	26'-1"	24'-2"	23'-0"	-	26'-8"	24'-9"	23'-7"	-
16"	NI-60	26'-5"	24'-6"	23'-5"	-	27'-2"	25'-3"	24'-2"	-
	NI-80	28'-2"	26'-1"	24'-10"	-	28'-10"	26'-9"	25'-6"	-
	NI-90	28'-8"	26'-6"	25'-3"	-	29'-3"	27'-2"	25'-11"	-

#### Notes:

1. The tabulated clear spans are based on CSA O86-14 and NBC 2015, and are applicable to residential floor construction meeting the above design criteria.
2. For multiple-span applications, the end spans shall be 40% or more of the adjacent span.
3. Minimum bearing length shall be 1-3/4 inch for end bearings, and 3-1/2 inches for intermediate bearings.
4. Bearing stiffeners are not required when I-joists are used in accordance with this table, except as required for hangers.
5. Nordic I-joists are listed in CCMC Evaluation Report 13032-R and APA Product Report PR-L274C.

### Maximum Floor Spans – M4.1

#### Design Criteria

Spans:	Simple span
Loads:	Live load = 40 psf and dead load = 20 psf
Deflection limits:	L/480 under live load and L/240 under total load
Sheathing:	3/4 in. nailed-glued oriented strand board (OSB) sheathing

#### Maximum Floor Spans

Joist depth	Joist series	Bare On centre spacing				1/2 in. gypsum ceiling On centre spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-11"	15'-0"	14'-6"	13'-5"	16'-5"	15'-5"	14'-6"	13'-5"
	NI-40x	17'-0"	16'-0"	15'-5"	14'-10"	17'-5"	16'-5"	15'-10"	14'-11"
	NI-60	17'-2"	16'-2"	15'-7"	14'-11"	17'-7"	16'-7"	16'-0"	15'-4"
	NI-80	18'-3"	17'-1"	16'-5"	15'-9"	18'-8"	17'-5"	16'-9"	16'-1"
11-7/8"	NI-20	17'-11"	16'-11"	16'-3"	15'-8"	18'-7"	17'-5"	16'-10"	16'-1"
	NI-40x	19'-4"	17'-11"	17'-3"	16'-7"	19'-11"	18'-6"	17'-9"	17'-0"
	NI-60	19'-7"	18'-2"	17'-6"	16'-9"	20'-2"	18'-9"	17'-11"	17'-2"
	NI-80	21'-1"	19'-6"	18'-6"	17'-7"	21'-7"	20'-0"	19'-0"	18'-0"
	NI-90	21'-6"	19'-10"	18'-11"	17'-11"	22'-0"	20'-4"	19'-5"	18'-4"
14"	NI-40x	21'-5"	19'-11"	18'-11"	18'-0"	22'-1"	20'-7"	19'-7"	18'-7"
	NI-60	21'-10"	20'-2"	19'-3"	18'-3"	22'-6"	20'-10"	19'-11"	18'-10"
	NI-80	23'-5"	21'-7"	20'-7"	19'-5"	24'-0"	22'-3"	21'-2"	20'-0"
	NI-90	23'-10"	22'-1"	21'-0"	19'-10"	24'-5"	22'-7"	21'-6"	20'-4"
16"	NI-60	23'-9"	22'-0"	21'-0"	19'-10"	24'-6"	22'-9"	21'-8"	20'-7"
	NI-80	25'-6"	23'-7"	22'-5"	21'-2"	26'-2"	24'-3"	23'-1"	21'-10"
	NI-90	26'-0"	24'-0"	22'-10"	21'-6"	26'-7"	24'-8"	23'-5"	22'-2"

Joist depth	Joist series	Mid-span blocking with 1x4 inch strap On centre spacing				Mid-span blocking and 1/2 in. gypsum ceiling On centre spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-10"	15'-5"	14'-6"	13'-5"	16'-10"	15'-5"	14'-6"	13'-5"
	NI-40x	18'-8"	17'-2"	16'-3"	14'-11"	18'-10"	17'-2"	16'-3"	14'-11"
	NI-60	18'-11"	17'-6"	16'-6"	15'-5"	19'-2"	17'-6"	16'-6"	15'-5"
	NI-80	20'-3"	18'-10"	17'-11"	16'-10"	20'-8"	19'-3"	18'-2"	16'-10"
11-7/8"	NI-20	20'-1"	18'-5"	17'-5"	16'-1"	20'-1"	18'-5"	17'-5"	16'-1"
	NI-40x	21'-10"	20'-4"	19'-0"	17'-0"	22'-5"	20'-6"	19'-0"	17'-0"
	NI-60	22'-1"	20'-7"	19'-8"	18'-4"	22'-8"	20'-10"	19'-8"	18'-4"
	NI-80	23'-8"	22'-0"	20'-11"	19'-10"	24'-1"	22'-6"	21'-6"	20'-0"
	NI-90	24'-1"	22'-5"	21'-4"	20'-2"	24'-7"	22'-11"	21'-10"	20'-7"
14"	NI-40x	24'-5"	22'-9"	20'-11"	18'-8"	25'-1"	22'-11"	20'-11"	18'-8"
	NI-60	24'-10"	23'-2"	22'-1"	20'-10"	25'-6"	23'-8"	22'-4"	20'-10"
	NI-80	26'-6"	24'-8"	23'-6"	22'-2"	27'-1"	25'-3"	24'-1"	22'-9"
	NI-90	27'-0"	25'-1"	23'-11"	22'-7"	27'-6"	25'-8"	24'-6"	23'-2"
16"	NI-60	27'-3"	25'-5"	24'-3"	22'-11"	28'-0"	26'-2"	24'-9"	23'-1"
	NI-80	29'-1"	27'-1"	25'-9"	24'-4"	29'-8"	27'-9"	26'-5"	25'-0"
	NI-90	29'-7"	27'-6"	26'-2"	24'-9"	30'-2"	28'-2"	26'-10"	25'-5"

#### Notes:

1. The tabulated clear spans are based on CSA O86-14 and NBC 2015, and are applicable to residential floor construction meeting the above design criteria.
2. For multiple-span applications, the end spans shall be 40% or more of the adjacent span.
3. Minimum bearing length shall be 1-3/4 inch for end bearings, and 3-1/2 inches for intermediate bearings.
4. Bearing stiffeners are not required when I-joists are used in accordance with this table, except as required for hangers.
5. Nordic I-joists are listed in CCMC Evaluation Report 13032-R and APA Product Report PR-L274C.

### Maximum Floor Spans – M6.1

#### Design Criteria

Spans:	Simple span
Loads:	Live load = 40 psf and dead load = 20 psf
Deflection limits:	L/480 under live load and L/240 under total load
Sheathing:	5/8 in. nailed-glued Canadian softwood plywood

#### Maximum Floor Spans

Joist depth	Joist series	Bare On centre spacing				1/2 in. gypsum ceiling On centre spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	14'-11"	14'-1"	13'-7"	-	15'-4"	14'-6"	14'-1"	-
	NI-40x	15'-11"	15'-0"	14'-6"	-	16'-4"	15'-5"	14'-11"	-
	NI-60	16'-1"	15'-2"	14'-8"	-	16'-6"	15'-7"	15'-1"	-
	NI-80	17'-1"	16'-1"	15'-6"	-	17'-5"	16'-5"	15'-10"	-
11-7/8"	NI-20	16'-9"	15'-10"	15'-4"	-	17'-4"	16'-4"	15'-10"	-
	NI-40x	17'-10"	16'-10"	16'-3"	-	18'-6"	17'-4"	16'-9"	-
	NI-60	18'-1"	17'-0"	16'-5"	-	18'-9"	17'-6"	16'-11"	-
	NI-80	19'-6"	18'-0"	17'-4"	-	20'-1"	18'-7"	17'-9"	-
	NI-90	19'-11"	18'-4"	17'-8"	-	20'-5"	18'-11"	18'-1"	-
14"	NI-40x	19'-10"	18'-4"	17'-8"	-	20'-6"	19'-1"	18'-3"	-
	NI-60	20'-2"	18'-8"	17'-11"	-	20'-10"	19'-4"	18'-6"	-
	NI-80	21'-8"	20'-0"	19'-1"	-	22'-4"	20'-8"	19'-9"	-
	NI-90	22'-1"	20'-5"	19'-6"	-	22'-9"	21'-0"	20'-1"	-
16"	NI-60	22'-0"	20'-4"	19'-6"	-	22'-9"	21'-1"	20'-2"	-
	NI-80	23'-7"	21'-10"	20'-10"	-	24'-4"	22'-6"	21'-6"	-
	NI-90	24'-1"	22'-2"	21'-2"	-	24'-9"	22'-11"	21'-10"	-

Joist depth	Joist series	Mid-span blocking with 1x4 inch strap On centre spacing				Mid-span blocking and 1/2 in. gypsum ceiling On centre spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-6"	15'-1"	14'-3"	-	16'-6"	15'-1"	14'-3"	-
	NI-40x	17'-9"	16'-10"	15'-11"	-	18'-2"	16'-11"	15'-11"	-
	NI-60	17'-11"	16'-11"	16'-2"	-	18'-5"	17'-2"	16'-2"	-
	NI-80	19'-3"	17'-10"	17'-3"	-	19'-8"	18'-3"	17'-7"	-
11-7/8"	NI-20	19'-4"	18'-0"	17'-1"	-	19'-9"	18'-1"	17'-1"	-
	NI-40x	20'-10"	19'-4"	18'-6"	-	21'-5"	19'-11"	19'-0"	-
	NI-60	21'-1"	19'-7"	18'-8"	-	21'-8"	20'-2"	19'-3"	-
	NI-80	22'-6"	20'-10"	19'-11"	-	23'-1"	21'-5"	20'-5"	-
	NI-90	23'-0"	21'-3"	20'-4"	-	23'-6"	21'-10"	20'-10"	-
14"	NI-40x	23'-5"	21'-8"	20'-9"	-	24'-0"	22'-5"	20'-11"	-
	NI-60	23'-9"	22'-0"	21'-0"	-	24'-5"	22'-8"	21'-8"	-
	NI-80	25'-4"	23'-6"	22'-5"	-	25'-11"	24'-1"	23'-0"	-
	NI-90	25'-10"	23'-11"	22'-9"	-	26'-5"	24'-6"	23'-4"	-
16"	NI-60	26'-2"	24'-3"	23'-2"	-	26'-11"	25'-0"	23'-11"	-
	NI-80	27'-11"	25'-10"	24'-7"	-	28'-7"	26'-6"	25'-3"	-
	NI-90	28'-5"	26'-3"	25'-0"	-	29'-0"	26'-11"	25'-8"	-

#### Notes:

1. The tabulated clear spans are based on CSA O86-14 and NBC 2015, and are applicable to residential floor construction meeting the above design criteria.
2. For multiple-span applications, the end spans shall be 40% or more of the adjacent span.
3. Minimum bearing length shall be 1-3/4 inch for end bearings, and 3-1/2 inches for intermediate bearings.
4. Bearing stiffeners are not required when I-joists are used in accordance with this table, except as required for hangers.
5. Nordic I-joists are listed in CCMC Evaluation Report 13032-R and APA Product Report PR-L274C.

## Maximum Floor Spans – M7.1

### Design Criteria

Spans:	Simple span
Loads:	Live load = 40 psf and dead load = 20 psf
Deflection limits:	L/480 under live load and L/240 under total load
Sheathing:	3/4 in. nailed-glued Canadian softwood plywood

### Maximum Floor Spans

Joist depth	Joist series	Bare On centre spacing				1/2 in. gypsum ceiling On centre spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-10"	15'-0"	14'-5"	13'-5"	16'-4"	15'-5"	14'-6"	13'-5"
	NI-40x	16'-11"	15'-11"	15'-4"	14'-9"	17'-4"	16'-4"	15'-9"	14'-11"
	NI-60	17'-1"	16'-1"	15'-6"	14'-10"	17'-6"	16'-6"	15'-11"	15'-3"
	NI-80	18'-1"	17'-0"	16'-4"	15'-8"	18'-7"	17'-4"	16'-8"	16'-0"
11-7/8"	NI-20	17'-10"	16'-10"	16'-2"	15'-7"	18'-5"	17'-4"	16'-9"	16'-1"
	NI-40x	19'-3"	17'-10"	17'-2"	16'-6"	19'-10"	18'-5"	17'-8"	16'-11"
	NI-60	19'-6"	18'-1"	17'-4"	16'-8"	20'-1"	18'-8"	17'-10"	17'-1"
	NI-80	20'-11"	19'-4"	18'-5"	17'-7"	21'-5"	19'-10"	18'-11"	17'-11"
	NI-90	21'-4"	19'-9"	18'-9"	17'-10"	21'-10"	20'-3"	19'-3"	18'-3"
14"	NI-40x	21'-4"	19'-9"	18'-10"	17'-11"	22'-0"	20'-5"	19'-6"	18'-6"
	NI-60	21'-8"	20'-1"	19'-2"	18'-2"	22'-4"	20'-9"	19'-9"	18'-9"
	NI-80	23'-3"	21'-6"	20'-5"	19'-4"	23'-10"	22'-1"	21'-0"	19'-11"
	NI-90	23'-9"	21'-11"	20'-10"	19'-8"	24'-3"	22'-6"	21'-5"	20'-3"
16"	NI-60	23'-7"	21'-10"	20'-10"	19'-9"	24'-4"	22'-7"	21'-7"	20'-5"
	NI-80	25'-4"	23'-5"	22'-3"	21'-1"	26'-0"	24'-1"	22'-11"	21'-8"
	NI-90	25'-10"	23'-10"	22'-8"	21'-5"	26'-5"	24'-6"	23'-4"	22'-0"

Joist depth	Joist series	Mid-span blocking with 1x4 inch strap On centre spacing				Mid-span blocking and 1/2 in. gypsum ceiling On centre spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-10"	15'-5"	14'-6"	13'-5"	16'-10"	15'-5"	14'-6"	13'-5"
	NI-40x	18'-7"	17'-2"	16'-3"	14'-11"	18'-10"	17'-2"	16'-3"	14'-11"
	NI-60	18'-10"	17'-6"	16'-6"	15'-5"	19'-1"	17'-6"	16'-6"	15'-5"
	NI-80	20'-2"	18'-9"	17'-11"	16'-10"	20'-7"	19'-2"	18'-2"	16'-10"
11-7/8"	NI-20	20'-1"	18'-5"	17'-5"	16'-1"	20'-1"	18'-5"	17'-5"	16'-1"
	NI-40x	21'-9"	20'-3"	19'-0"	17'-0"	22'-4"	20'-5"	19'-0"	17'-0"
	NI-60	22'-0"	20'-6"	19'-7"	18'-4"	22'-7"	20'-10"	19'-8"	18'-4"
	NI-80	23'-6"	21'-10"	20'-10"	19'-9"	24'-0"	22'-5"	21'-4"	20'-0"
	NI-90	24'-0"	22'-4"	21'-3"	20'-1"	24'-6"	22'-10"	21'-9"	20'-7"
14"	NI-40x	24'-4"	22'-8"	20'-11"	18'-8"	25'-0"	22'-11"	20'-11"	18'-8"
	NI-60	24'-9"	23'-0"	22'-0"	20'-9"	25'-5"	23'-8"	22'-4"	20'-10"
	NI-80	26'-5"	24'-6"	23'-4"	22'-1"	27'-0"	25'-2"	24'-0"	22'-8"
	NI-90	26'-11"	25'-0"	23'-10"	22'-6"	27'-5"	25'-7"	24'-5"	23'-1"
16"	NI-60	27'-2"	25'-4"	24'-2"	22'-10"	27'-11"	26'-1"	24'-9"	23'-1"
	NI-80	29'-0"	26'-11"	25'-8"	24'-3"	29'-7"	27'-7"	26'-4"	24'-11"
	NI-90	29'-6"	27'-5"	26'-1"	24'-8"	30'-1"	28'-1"	26'-9"	25'-4"

### Notes:

1. The tabulated clear spans are based on CSA O86-14 and NBC 2015, and are applicable to residential floor construction meeting the above design criteria.
2. For multiple-span applications, the end spans shall be 40% or more of the adjacent span.
3. Minimum bearing length shall be 1-3/4 inch for end bearings, and 3-1/2 inches for intermediate bearings.
4. Bearing stiffeners are not required when I-joists are used in accordance with this table, except as required for hangers.
5. Nordic I-joists are listed in CCMC Evaluation Report 13032-R and APA Product Report PR-L274C.