

Schedule 1: Designer Information

Use one form for each individual who reviews and takes responsibility for design activities with respect to the project.

A. Project Information				
Building number, street name			Unit no.	Lot/con.
Municipality BRAMPTON	Postal code	Plan number/ other description		
B. Individual who reviews and takes responsibility for design activities				
Name MICHAEL O'ROURKE		Firm HVAC DESIGNS LTD		
Street address 375 FINLEY AVE		Unit no. 202	Lot/con. N/A	
Municipality AJAX	Postal code L1S 2E2	Province ONTARIO	E-mail info@hvacdesigns.ca	
Telephone number (905) 619-2300	Fax number (905) 619-2375	Cell number ()		
C. Design activities undertaken by individual identified in Section B. [Building Code Table 3.5.2.1 OF Division C]				
☐ House ☐ Small Buildings ☐ Large Buildings ☐ Complex Buildings ☒ HVAC – House ☐ Building Services ☐ Detection, Lighting and Power ☐ Fire Protection ☐ Building Structural ☐ Plumbing – House ☐ Plumbing – All Buildings ☐ On-site Sewage Systems				
Description of designer's work HEAT LOSS / GAIN CALCULATIONS DUCT SIZING RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY RESIDENTIAL SYSTEM DESIGN per CSA-F280-12		Model: 5003 Project: VALES OF HUMBER SOUTH		
D. Declaration of Designer				
I, <u>MICHAEL O'ROURKE</u> (print name) declare that (choose one as appropriate):				
☐ I review and take responsibility for the design work on behalf of a firm registered under subsection 3.2.4. of Division C, of the Building Code. I am qualified, and the firm is registered, in the appropriate classes/categories. Individual BCIN: _____ Firm BCIN: _____				
☒ I review and take responsibility for the design and am qualified in the appropriate category as an "other designer" under subsection 3.2.5. of Division C, of the Building Code. Individual BCIN: <u>19669</u> Basis for exemption from registration and qualification: <u>O.B.C SENTENCE 3.2.4.1 (4)</u>				
☐ The design work is exempt from the registration and qualification requirements of the Building Code. Basis for exemption from registration and qualification: _____				
I certify that:				
1. The information contained in this schedule is true to the best of my knowledge. 2. I have submitted this application with the knowledge and consent of the firm.				
July 10, 2024		 Signature of Designer		
Date				

NOTE:

- For the purposes of this form, "individual" means the "person" referred to in Clause 3.2.4.7(1) d) of Division C, Article 3.2.5.1. of Division C, and all other persons who are exempt from qualification under Subsections 3.2.4. and 3.2.5. of Division C.
- Schedule 1 is not required to be completed by a holder of a license, temporary license, or a certificate of authorization, issued by the Ontario Association of Architects. Schedule 1 is also not required to be completed by a holder of a license to practise, a limited license to practise, or a certificate of authorization, issued by the Association of Professional Engineers of Ontario.

Application for a Permit Construct or Demolish – Effective January 1, 2015

SITE NAME: VALES OF HUMBER SOUTH

BUILDER: ROYAL PINE HOMES

TYPE: 5003

GFA: 4036

DATE: Jul-24

LO# 95281

WINTER NATURAL AIR CHANGE RATE 0.234

SUMMER NATURAL AIR CHANGE RATE 0.076

HEAT LOSS AT °F. 74

HEAT GAIN AT °F. 11

CSA-F280-12

PERFORMANCE

ROOM USE	EXP. WALL	CLG. HT.	FACTORS	MBR	ENS	BED-2	BED-3	BED-4	BTH-2/3	MD/B5	BTH-4/5		
GRS.WALL AREA	LOSS	GAIN	414	252	162	162	306	225	126	90			
GLAZING	LOSS	GAIN	LOSS	GAIN	LOSS	LOSS	LOSS	LOSS	LOSS	LOSS	LOSS		
NORTH	20.8	12.8	0	0	0	24	499	308	0	0	0	0	0
EAST	20.8	32.9	0	0	0	0	0	0	44	914	1448	44	914
SOUTH	20.8	19.8	0	0	0	0	0	0	0	0	0	0	0
WEST	20.8	32.9	46	956	1514	13	270	428	13	270	428	13	270
SKYLT.	34.1	132.1	0	0	0	0	0	0	0	0	0	0	0
DOORS	19.6	2.9	0	0	0	0	0	0	0	0	0	0	0
NET EXPOSED WALL	3.5	0.5	368	1276	189	217	752	112	138	478	71	118	409
NET EXPOSED BSMT WALL ABOVE GR	3.5	0.5	0	0	0	0	0	0	262	908	135	212	735
EXPOSED CLG	1.3	0.6	593	743	330	195	244	109	0	0	0	0	0
NO ATTIC EXPOSED CLG	2.7	1.2	0	0	0	0	0	0	0	0	0	0	0
EXPOSED FLOOR	2.5	0.4	0	0	0	0	0	0	126	314	47	0	0
BASEMENT/CRAWL HEAT LOSS			0	0	0	0	0	0	0	0	0	0	0
SLAB ON GRADE HEAT LOSS			0	0	0	0	0	0	0	0	0	0	0
SUBTOTAL HT LOSS			2975		1724	1627		2416	1477	1256	698		
SUB TOTAL HT GAIN				2034	930	609		1788	1847	654	334		
LEVEL FACTOR / MULTIPLIER	0.20	0.25				0.20	0.25		0.20	0.25		0.20	0.25
AIR CHANGE HEAT LOSS			755		438	413		613	375	319	177		
AIR CHANGE HEAT GAIN				120	55	36		106	39	41	20		
DUCT LOSS			0		0	204		303	185	0	0		
DUCT GAIN			0		0	163		288	69	0	0		
HEAT GAIN PEOPLE	240	2	480	0	0	1	240	1	240	0	0	1	240
HEAT GAIN APPLIANCES/LIGHTS			748	0	0	748		748	748	748	0	748	0
TOTAL HT LOSS BTU/H			3730		2162	2245		3332	2037	1575	875		
TOTAL HT GAIN x 1.3 BTU/H			4397		1281	2335		4121	3828	2228	460		

ROOM USE	EXP. WALL	CLG. HT.	FACTORS	FAM	DIN	KT/DN	LIV	LIB	PWD	FOY	LND		
GRS.WALL AREA	LOSS	GAIN	429	176	440	143	352	77	220	275			
GLAZING	LOSS	GAIN	LOSS	GAIN	LOSS	LOSS	LOSS	LOSS	LOSS	LOSS	LOSS		
NORTH	20.8	12.8	0	0	0	0	0	0	0	0	20	416	256
EAST	20.8	32.9	0	0	0	0	0	0	39	810	1284	0	0
SOUTH	20.8	19.8	0	0	0	24	499	476	0	0	0	0	0
WEST	20.8	32.9	84	1745	2765	0	0	0	0	0	0	0	0
SKYLT.	34.1	132.1	0	0	0	0	0	0	0	0	0	0	0
DOORS	19.6	2.9	0	0	0	10	196	29	0	0	0	0	0
NET EXPOSED WALL	3.5	0.5	345	1196	177	152	527	78	369	1279	190	115	399
NET EXPOSED BSMT WALL ABOVE GR	3.5	0.5	0	0	0	0	0	0	0	0	0	0	0
EXPOSED CLG	1.3	0.6	0	0	0	0	0	0	0	0	0	0	0
NO ATTIC EXPOSED CLG	2.7	1.2	10	27	12	0	0	0	0	0	0	0	0
EXPOSED FLOOR	2.5	0.4	0	0	0	0	0	0	0	0	0	0	0
BASEMENT/CRAWL HEAT LOSS			0	0	0	0	0	0	0	0	0	0	0
SLAB ON GRADE HEAT LOSS			0	0	0	0	0	0	0	0	0	0	0
SUBTOTAL HT LOSS			2968		1026	2743		980	2069	267	2179	1783	
SUB TOTAL HT GAIN				2954	554	2226		614	1768	40	1515	459	
LEVEL FACTOR / MULTIPLIER	0.30	0.40				0.30	0.40		0.30	0.40	0.30	0.40	
AIR CHANGE HEAT LOSS			1177		407	1087		389	820	106	864	707	
AIR CHANGE HEAT GAIN				175	33	132		36	105	2	90	27	
DUCT LOSS			0		0	0		0	0	0	0	0	
DUCT GAIN			0		0	0		0	0	0	0	0	
HEAT GAIN PEOPLE	240	0	0	0	0	0	0	0	0	0	0	0	0
HEAT GAIN APPLIANCES/LIGHTS			748		748	748		748	748	0	748	748	
TOTAL HT LOSS BTU/H			4145		1432	3830		1369	2889	373	3043	2490	
TOTAL HT GAIN x 1.3 BTU/H			5040		1736	4038		1819	3408	55	2086	1605	

TOTAL HEAT GAIN BTU/H:

41847

TONS: 3.49

LOSS DUE TO VENTILATION LOAD BTU/H: 1911

STRUCTURAL HEAT LOSS: 57950

TOTAL COMBINED HEAT LOSS BTU/H: 59861

TYPE: 5003
SITE NAME: VALES OF HUMBER SOUTH

LO # 95281

RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY

COMBUSTION APPLIANCES		9.32.3.1(1)
a)	☒ Direct vent (sealed combustion) only	
b)	☐ Positive venting induced draft (except fireplaces)	
c)	☐ Natural draft, B-vent or induced draft gas fireplace	
d)	☐ Solid Fuel (including fireplaces)	
e)	☐ No Combustion Appliances	

HEATING SYSTEM	
☒ Forced Air	☐ Non Forced Air
☐ Electric Space Heat	

HOUSE TYPE		9.32.1(2)
☒ I	Type a) or b) appliance only, no solid fuel	
☐ II	Type I except with solid fuel (including fireplaces)	
☐ III	Any Type c) appliance	
☐ IV	Type I, or II with electric space heat	
☐	Other: Type I, II or IV no forced air	

SYSTEM DESIGN OPTIONS		O.N.H.W.P.
☐ 1	Exhaust only/Forced Air System	
☐ 2	HRV with Ducting/Forced Air System	
☒ 3	HRV Simplified/connected to forced air system	
☐ 4	HRV with Ducting/non forced air system	
☐	Part 6 Design	

TOTAL VENTILATION CAPACITY		9.32.3.3(1)
Basement + Master Bedroom	<u>2</u> @ 21.2 cfm	<u>42.4</u> cfm
Other Bedrooms	<u>4</u> @ 10.6 cfm	<u>42.4</u> cfm
Kitchen & Bathrooms	<u>5</u> @ 10.6 cfm	<u>53</u> cfm
Other Rooms	<u>6</u> @ 10.6 cfm	<u>63.6</u> cfm
Table 9.32.3.A.	TOTAL	<u>201.4</u> cfm

PRINCIPAL VENTILATION CAPACITY REQUIRED		9.32.3.4.(1)
1 Bedroom	31.8	cfm
2 Bedroom	47.7	cfm
3 Bedroom	63.6	cfm
4 Bedroom	79.5	cfm
5 Bedroom	95.4	cfm
TOTAL		<u>95.4</u> cfm

SUPPLEMENTAL VENTILATION CAPACITY		9.32.3.5.
Total Ventilation Capacity	<u>201.4</u>	cfm
Less Principal Ventil. Capacity	<u>95.4</u>	cfm
Required Supplemental Capacity	<u>106.0</u>	cfm

PRINCIPAL EXHAUST FAN CAPACITY	
Model:	VANEE V150H
Location:	BSMT
<u>95.4</u> cfm	☒ HVI Approved

PRINCIPAL EXHAUST HEAT LOSS CALCULATION				
CFM	ΔT °F	FACTOR	% LOSS	
95.4 CFM	X 74 F	X 1.08	X	0.25

SUPPLEMENTAL FANS		BY INSTALLING CONTRACTOR		
Location	Model	cfm	HVI	Sones
ENS	BY INSTALLING CONTRACTOR	50	☒	3.5
BTH-2/3	BY INSTALLING CONTRACTOR	50	☒	3.5
BTH-4/5	BY INSTALLING CONTRACTOR	50	☒	3.5
PWD	BY INSTALLING CONTRACTOR	50	☒	3.5

HEAT RECOVERY VENTILATOR		9.32.3.11.
Model:	VANEE V150H	
<u>150</u>	cfm high	<u>35</u> cfm low
<u>75</u>	% Sensible Efficiency @ 32 deg F (0 deg C)	☒ HVI Approved

LOCATION OF INSTALLATION	
Lot:	Concession
Township	Plan:
Address	
Roll #	Building Permit #

BUILDER:	
ROYAL PINE HOMES	
Name:	
Address:	
City:	
Telephone #:	Fax #:

INSTALLING CONTRACTOR	
Name:	
Address:	
City:	
Telephone #:	Fax #:

DESIGNER CERTIFICATION	
I hereby certify that this ventilation system has been designed in accordance with the Ontario Building Code.	
Name:	HVAC Designs Ltd.
Signature:	<i>Michael O'Rourke</i>
HRAI #	001820
Date:	July-24

I REVIEW AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED IN THE APPROPRIATE CATEGORY AS AN "OTHER DESIGNER" UNDER DIVISION C, 3.2.5 OF THE BUILDING CODE.

INDIVIDUAL BCIN: 19669

MICHAEL O'ROURKE

Michael O'Rourke

CSA F280-12 Residential Heat Loss and Heat Gain Calculations																																																												
Formula Sheet (For Air Leakage / Ventilation Calculation)																																																												
LO#: 95281	Model: 5003	Builder: ROYAL PINE HOMES	Date: 7/10/2024																																																									
Volume Calculation			Air Change & Delta T Data																																																									
House Volume <table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th>Level</th> <th>Floor Area (ft²)</th> <th>Floor Height (ft)</th> <th>Volume (ft³)</th> </tr> </thead> <tbody> <tr><td>Bsmt</td><td>1883</td><td>10</td><td>18830</td></tr> <tr><td>First</td><td>1883</td><td>11</td><td>20713</td></tr> <tr><td>Second</td><td>2220</td><td>9</td><td>19980</td></tr> <tr><td>Third</td><td>0</td><td>9</td><td>0</td></tr> <tr><td>Fourth</td><td>0</td><td>9</td><td>0</td></tr> <tr><td colspan="3" style="text-align: right;">Total:</td><td>59,523.0 ft³</td></tr> <tr><td colspan="3" style="text-align: right;">Total:</td><td>1685.5 m³</td></tr> </tbody> </table>			Level	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)	Bsmt	1883	10	18830	First	1883	11	20713	Second	2220	9	19980	Third	0	9	0	Fourth	0	9	0	Total:			59,523.0 ft³	Total:			1685.5 m³	<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <td style="width: 80%;">WINTER NATURAL AIR CHANGE RATE</td> <td style="width: 20%; text-align: center;">0.234</td> </tr> <tr> <td>SUMMER NATURAL AIR CHANGE RATE</td> <td style="text-align: center;">0.076</td> </tr> </table> <table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th colspan="5" style="text-align: center;">Design Temperature Difference</th> </tr> <tr> <th></th> <th>Tin °C</th> <th>Tout °C</th> <th>ΔT °C</th> <th>ΔT °F</th> </tr> <tr> <td>Winter DTDh</td> <td style="text-align: center;">22</td> <td style="text-align: center;">-19</td> <td style="text-align: center;">41</td> <td style="text-align: center;">74</td> </tr> <tr> <td>Summer DTDc</td> <td style="text-align: center;">24</td> <td style="text-align: center;">30</td> <td style="text-align: center;">6</td> <td style="text-align: center;">11</td> </tr> </table>		WINTER NATURAL AIR CHANGE RATE	0.234	SUMMER NATURAL AIR CHANGE RATE	0.076	Design Temperature Difference						Tin °C	Tout °C	ΔT °C	ΔT °F	Winter DTDh	22	-19	41	74	Summer DTDc	24	30	6	11
Level	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)																																																									
Bsmt	1883	10	18830																																																									
First	1883	11	20713																																																									
Second	2220	9	19980																																																									
Third	0	9	0																																																									
Fourth	0	9	0																																																									
Total:			59,523.0 ft³																																																									
Total:			1685.5 m³																																																									
WINTER NATURAL AIR CHANGE RATE	0.234																																																											
SUMMER NATURAL AIR CHANGE RATE	0.076																																																											
Design Temperature Difference																																																												
	Tin °C	Tout °C	ΔT °C	ΔT °F																																																								
Winter DTDh	22	-19	41	74																																																								
Summer DTDc	24	30	6	11																																																								
5.2.3.1 Heat Loss due to Air Leakage			6.2.6 Sensible Gain due to Air Leakage																																																									
$HL_{airb} = LR_{airh} \times \frac{V_b}{3.6} \times DTD_h \times 1.2$ 0.234 x 468.20 x 41 °C x 1.2 = 5428 W = 18522 Btu/h			$HG_{salb} = LR_{airc} \times \frac{V_b}{3.6} \times DTD_c \times 1.2$ = 0.076 x 468.20 x 6 °C x 1.2 = 262 W = 893 Btu/h																																																									
5.2.3.2 Heat Loss due to Mechanical Ventilation			6.2.7 Sensible heat Gain due to Ventilation																																																									
$HL_{vairb} = PVC \times DTD_h \times 1.08 \times (1 - E)$ 95 CFM x 74 °F x 1.08 x 0.25 = 1911 Btu/h			$HL_{vairb} = PVC \times DTD_h \times 1.08 \times (1 - E)$ 95 CFM x 11 °F x 1.08 x 0.25 = 283 Btu/h																																																									
5.2.3.3 Calculation of Air Change Heat Loss for Each Room (Floor Multiplier Section)																																																												
$HL_{airr} = Level\ Factor \times HL_{airbv} \times \{(HL_{agcr} + HL_{bgcr}) \div (HL_{agclevel} + HL_{bgclevel})\}$																																																												
Level	Level Factor (LF)	HLairve Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{clevel})	Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)																																																								
1	0.5	18,522	10,133	0.914																																																								
2	0.3		14,014	0.396																																																								
3	0.2		14,589	0.254																																																								
4	0		0	0.000																																																								
5	0		0	0.000																																																								
*HLairbv = Air leakage heat loss + ventilation heat loss *For a balanced or supply only ventilation system HLairve = 0																																																												
				Michael O'Rourke BCIN# 19669 																																																								

HEAT LOSS AND GAIN SUMMARY SHEET

MODEL: 5003	BUILDER: ROYAL PINE HOMES
SFQT: 4036	SITE: VALES OF HUMBER SOUTH
LO# 95281	

DESIGN ASSUMPTIONS

HEATING	°F	COOLING	°F
OUTDOOR DESIGN TEMP.	-2	OUTDOOR DESIGN TEMP.	86
INDOOR DESIGN TEMP.	72	INDOOR DESIGN TEMP. (MAX 75°F)	75
		WINDOW SHGC	0.60

BUILDING DATA

ATTACHMENT:	DETACHED	# OF STORIES (+BASEMENT):	3
FRONT FACES:	EAST	ASSUMED (Y/N):	Y
AIR CHANGES PER HOUR:	2.50	ASSUMED (Y/N):	Y
AIR TIGHTNESS CATEGORY:	TIGHT	ASSUMED (Y/N):	Y
WIND EXPOSURE:	SHELTERED	ASSUMED (Y/N):	Y
HOUSE VOLUME (ft ³):	59523.0	ASSUMED (Y/N):	Y
INTERNAL SHADING:	BLINDS/CURTAINS	ASSUMED OCCUPANTS:	6
INTERIOR LIGHTING LOAD (Btu/h/ft ²):	1.50	DC BRUSHLESS MOTOR (Y/N):	Y
FOUNDATION CONFIGURATION	BCIN_1	DEPTH BELOW GRADE:	7.0 ft
LENGTH: 57.0 ft	WIDTH: 44.0 ft	EXPOSED PERIMETER:	202.0 ft

2012 OBC - COMPLIANCE PACKAGE**Component****Compliance Package
PERFORMANCE****Nominal Min. Eff.**

Ceiling with Attic Space Minimum RSI (R)-Value	60	59.22
Ceiling Without Attic Space Minimum RSI (R)-Value	31	27.65
Exposed Floor Minimum RSI (R)-Value	31	29.80
Walls Above Grade Minimum RSI (R)-Value	22+1.5	21.40
Basement Walls Minimum RSI (R)-Value	20	21.12
Below Grade Slab Entire surface > 600 mm below grade Minimum RSI (R)-Value	-	-
Edge of Below Grade Slab ≤ 600 mm Below Grade Minimum RSI (R)-Value	10	10
Heated Slab or Slab ≤ 600 mm below grade Minimum RSI (R)-Value	10	11.13
Windows and Sliding Glass Doors Maximum U-Value	1.6	-
Skylights Maximum U-Value	2.6	-
Space Heating Equipment Minimum AFUE	96%	-
HRV/ERV Minimum Efficiency	75%	-
Domestic Hot Water Heater Minimum EF	.90 EF	-


INDIVIDUAL BCIN: 19669

MICHAEL O'ROURKE



Residential Foundation Thermal Load Calculator

Supplemental tool for CAN/CSA-F280

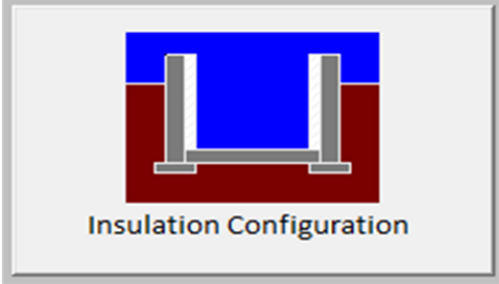Weather Station Description		
Province:	Ontario	
Region:	Brampton	
Site Description		
Soil Conductivity:	Normal conductivity: dry sand, loam, clay	
Water Table:	Normal (7-10 m, 23-33 ft)	
Foundation Dimensions		
Floor Length (m):	17.4	 Insulation Configuration
Floor Width (m):	13.4	
Exposed Perimeter (m):	0.0	
Wall Height (m):	3.0	
Depth Below Grade (m):	2.13	
Window Area (m ²):	1.9	
Door Area (m ²):	1.9	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	33	
Design Months		
Heating Month	1	
Foundation Loads		
Heating Load (Watts):		2109

TYPE: 5003
LO# 95281

Air Infiltration Residential Load Calculator


Supplemental tool for CAN/CSA-F280

Weather Station Description				
Province:	Ontario			
Region:	Brampton			
Weather Station Location:	Open flat terrain, grass			
Anemometer height (m):	10			
Local Shielding				
Building Site:	Suburban, forest			
Walls:	Heavy			
Flue:	Heavy			
Highest Ceiling Height (m):	7.01			
Building Configuration				
Type:	Detached			
Number of Stories:	Two			
Foundation:	Full			
House Volume (m ³):	1685.5			
Air Leakage/Ventilation				
Air Tightness Type:	Detached (2.5 ACH)			
Custom BDT Data:	ELA @ 10 Pa.	1573.4 cm ²		
	2.50	ACH @ 50 Pa		
Mechanical Ventilation (L/s):	Total Supply	Total Exhaust		
	45.0	45.0		
Flue Size				
Flue #:	#1	#2	#3	#4
Diameter (mm):	0	0	0	0
Natural Infiltration Rates				
Heating Air Leakage Rate (ACH/H):	0.234			
Cooling Air Leakage Rate (ACH/H):	0.076			


TYPE: 5003
LO# 95281

Michael O'Rourke BCIN# 19669



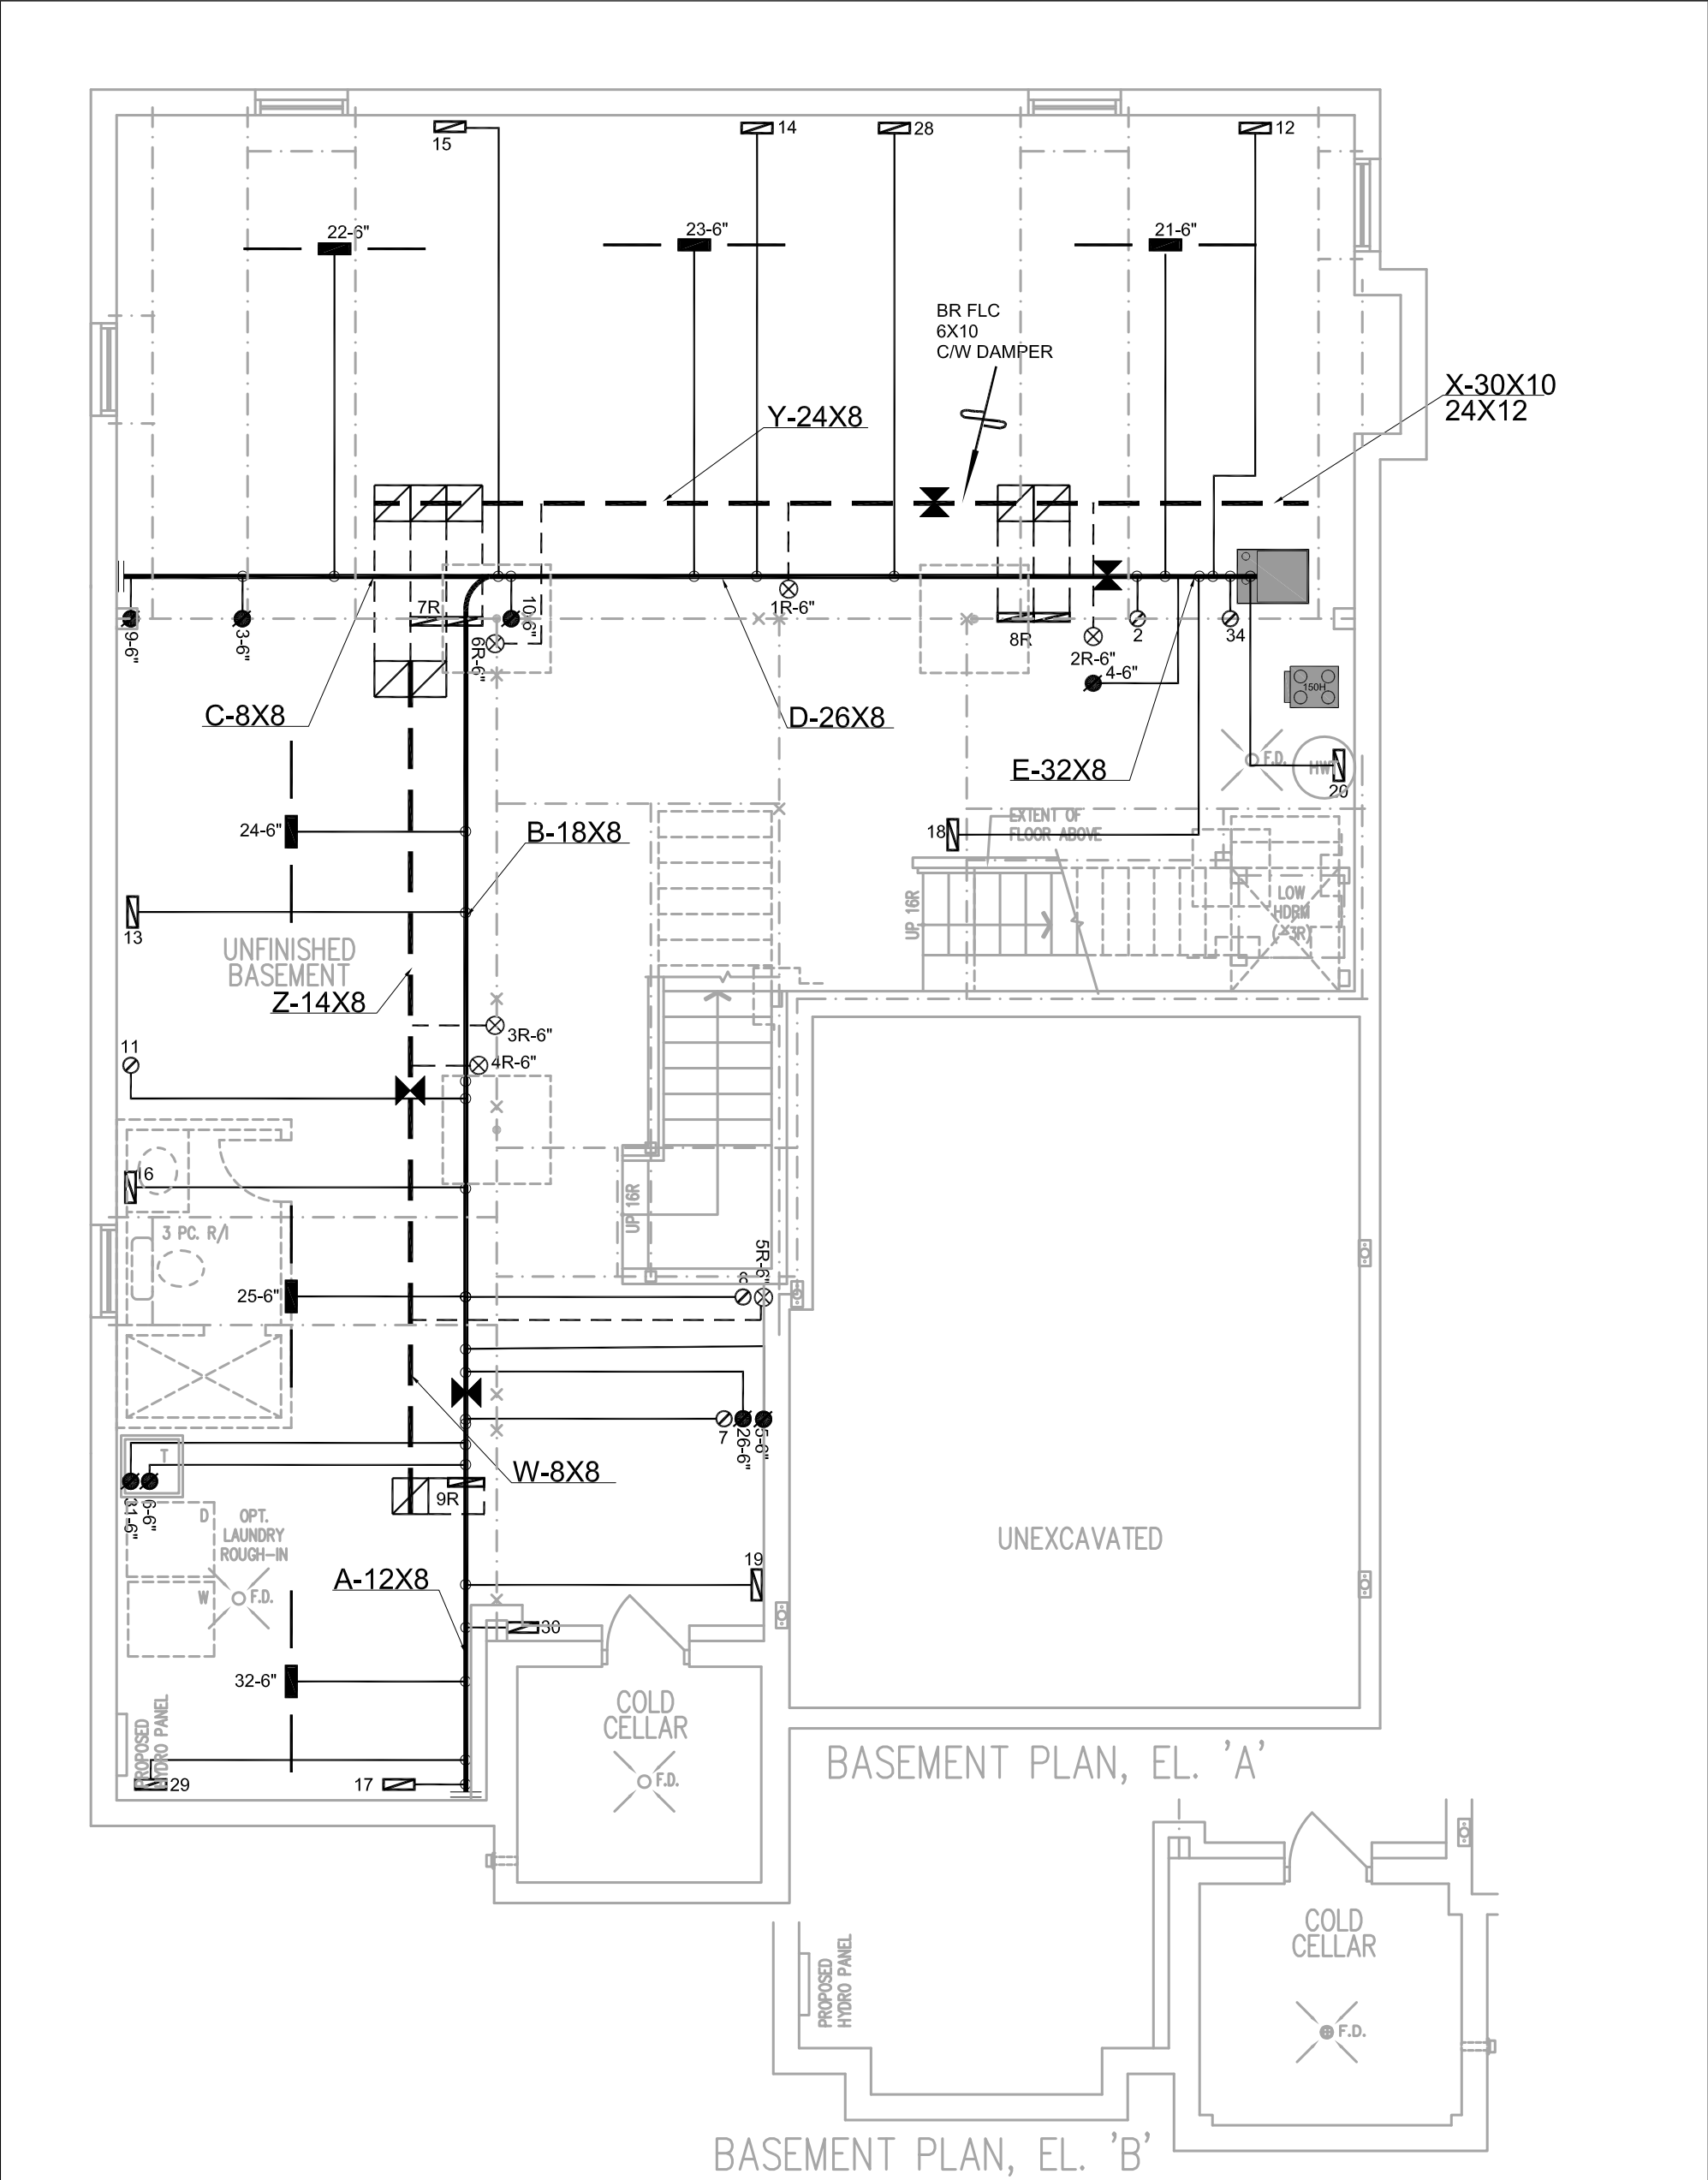

HVAC LEGEND								3.			
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.	UPDATED EQUIPMENT	JUL/2024	
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.	REVISED TO PERFORMANCE PATH	MAR/2022	
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description	Date	
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	REVISIONS			
ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.						I Michael O'Rourke have reviewed and take responsibility for the design work and am qualified under division C.3.2.5 of the building code. Michael O'Rourke BCIN # 19669 HVAC Designs Ltd.		SB-12 PERFORMANCE			
Client		375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdesigns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services				HEAT LOSS 59861 BTU/H		# OF RUNS S/A R/A FANS		Sheet Title	
ROYAL PINE HOMES						UNIT DATA		3RD FLOOR		BASEMENT	
Project Name						CARRIER		2ND FLOOR		HEATING	
VALES OF HUMBER SOUTH						MODEL		1ST FLOOR		LAYOUT	
BRAMPTON, ONTARIO						59SC6A080M17--16		BASEMENT		Date	
5003		4036 sqft		INPUT		80 MBTU/H		MAR/2022			
				OUTPUT		78 MBTU/H		Scale			
				COOLING		3.5 TONS		3/16" = 1'-0"			
				FAN SPEED		1265 cfm @ 0.6" w.c.		BCIN# 19669			
								LO# 95281			
		Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.									

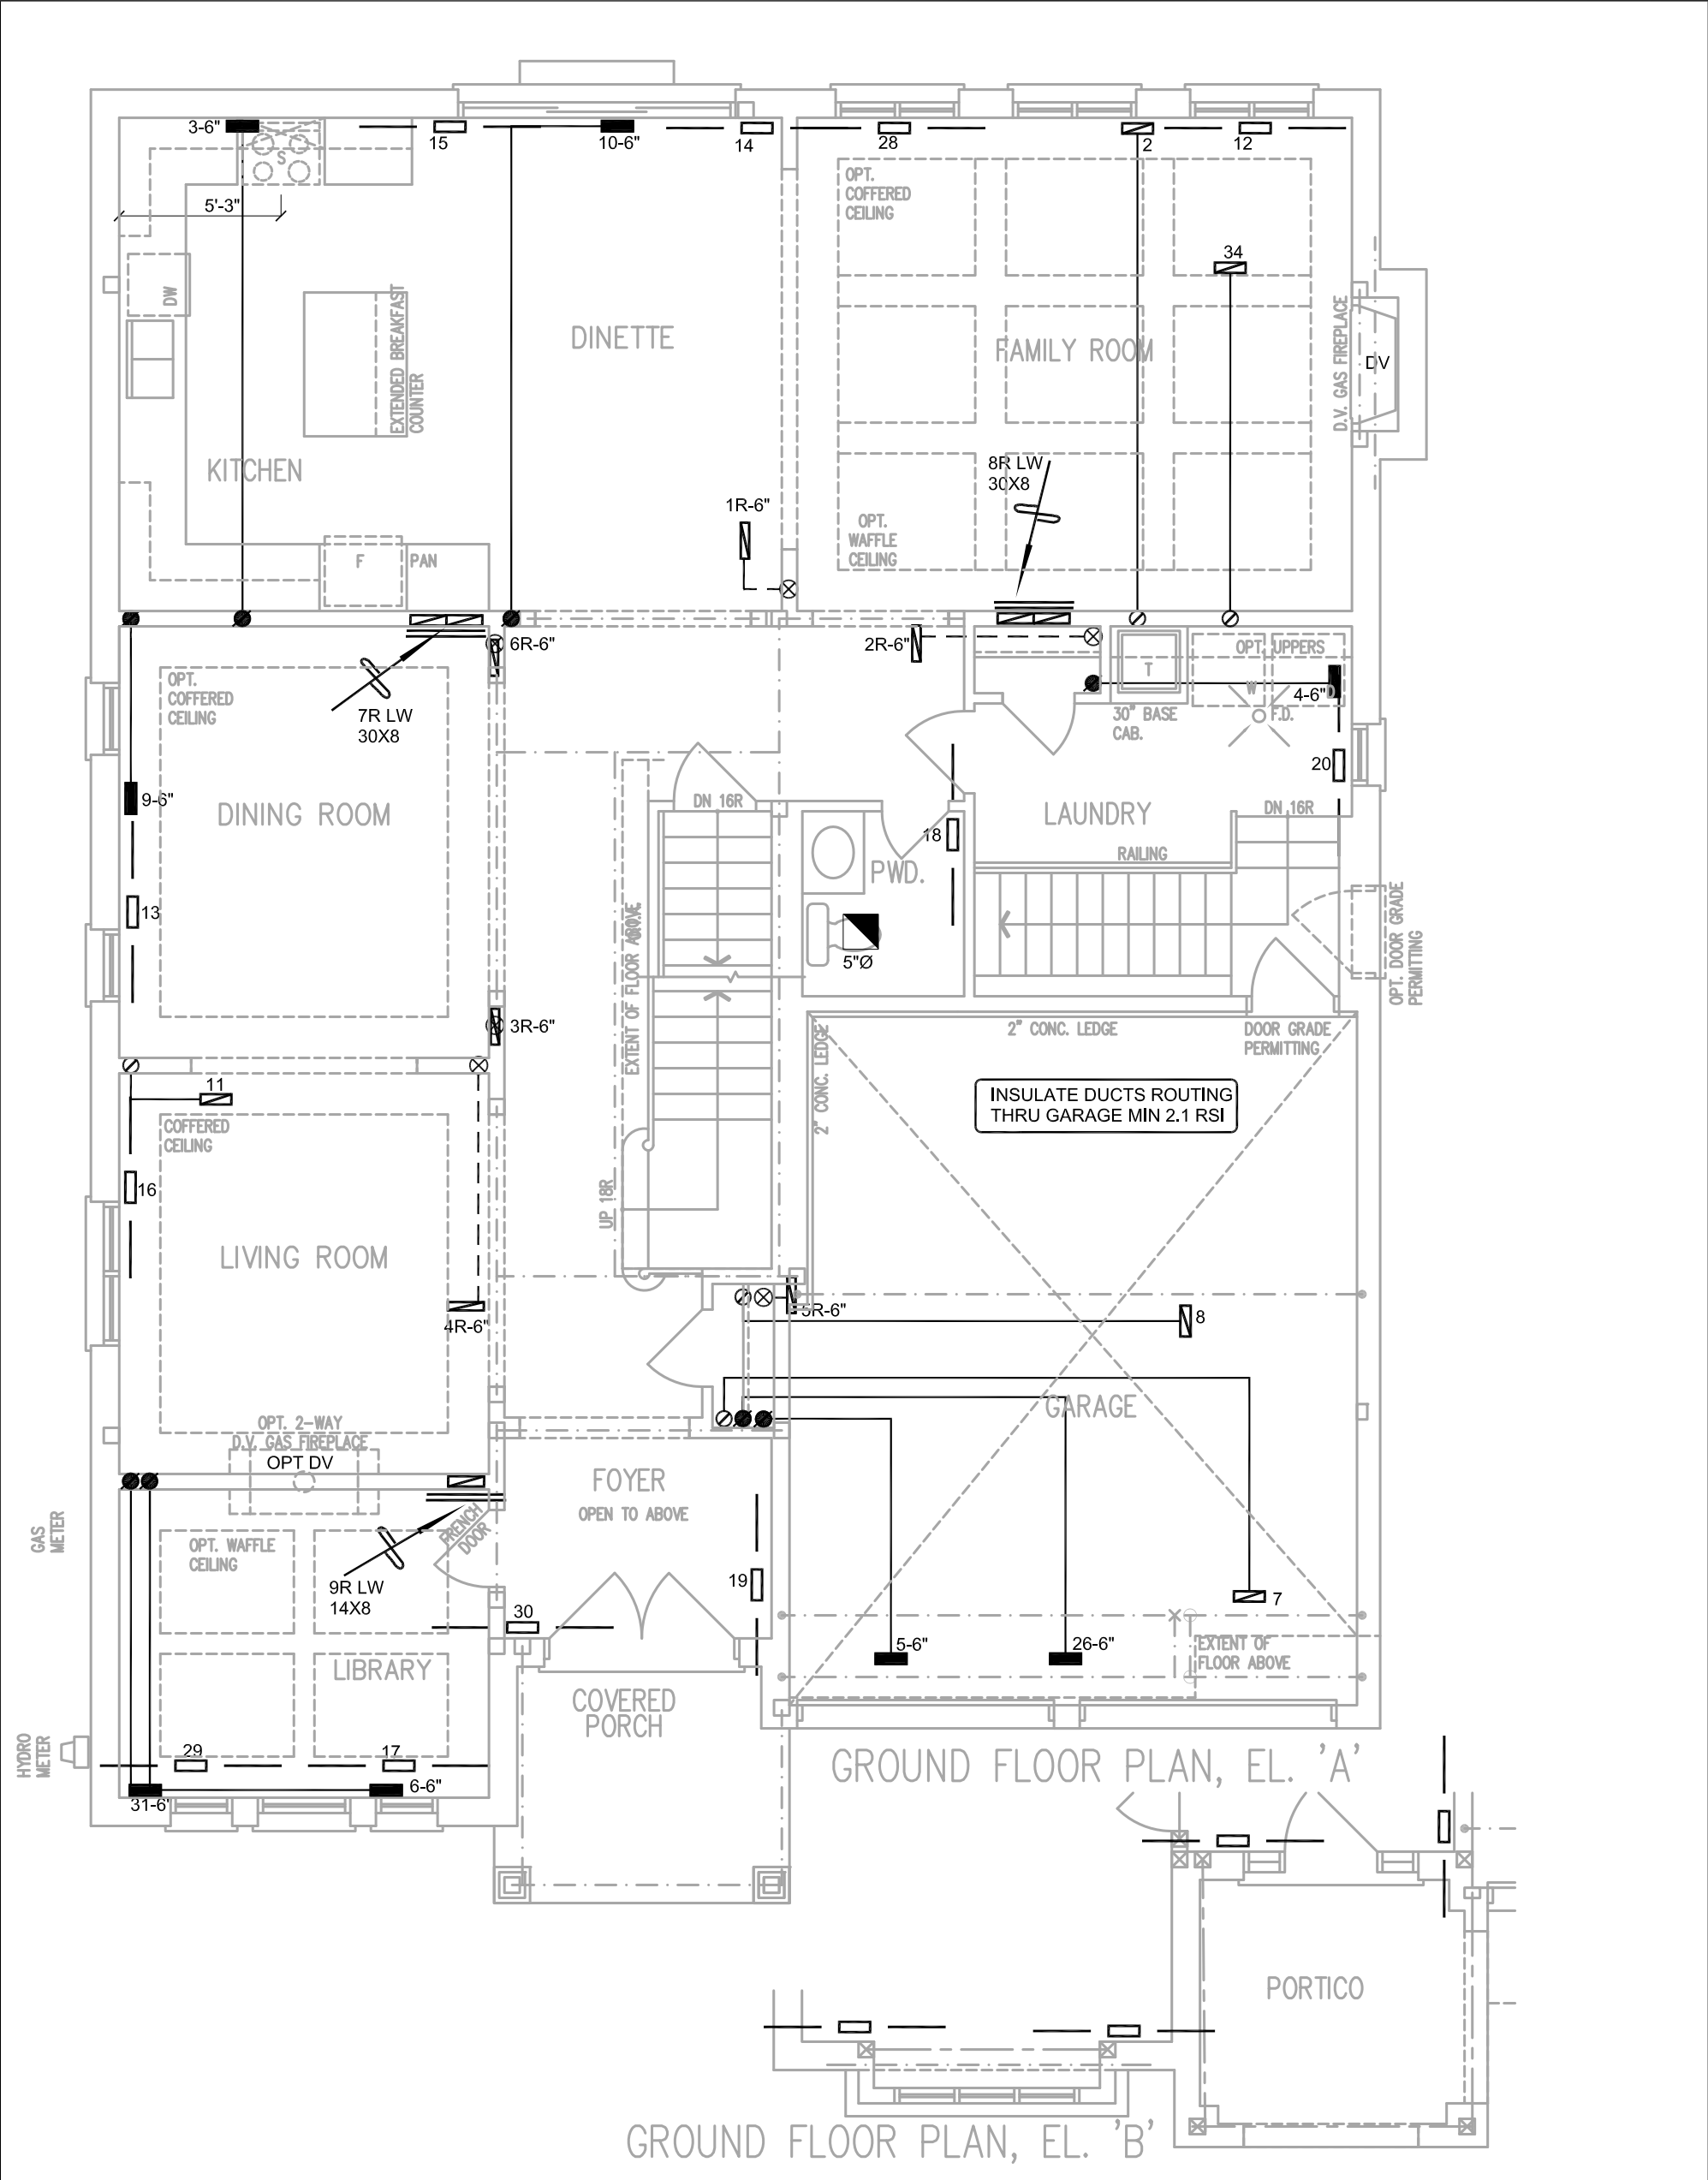

HVAC LEGEND								3.		
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.	UPDATED EQUIPMENT	JUL/2024
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.	REVISED TO PERFORMANCE PATH	MAR/2022
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description	Date
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	REVISIONS		


ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

I Michael O'Rourke have reviewed and take responsibility for the design work and am qualified under division C.3.2.5 of the building code.

Michael O'Rourke
Michael O'Rourke BCIN # 19669
HVAC Designs Ltd.

SB-12 PERFORMANCE

Client		 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdesigns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.	Sheet Title	
ROYAL PINE HOMES			FIRST FLOOR HEATING LAYOUT	
Project Name			Date	MAR/2022
VALES OF HUMBER SOUTH BRAMPTON, ONTARIO			Scale	3/16" = 1'-0"
5003			BCIN# 19669	
4036 sqft			LO#	95281

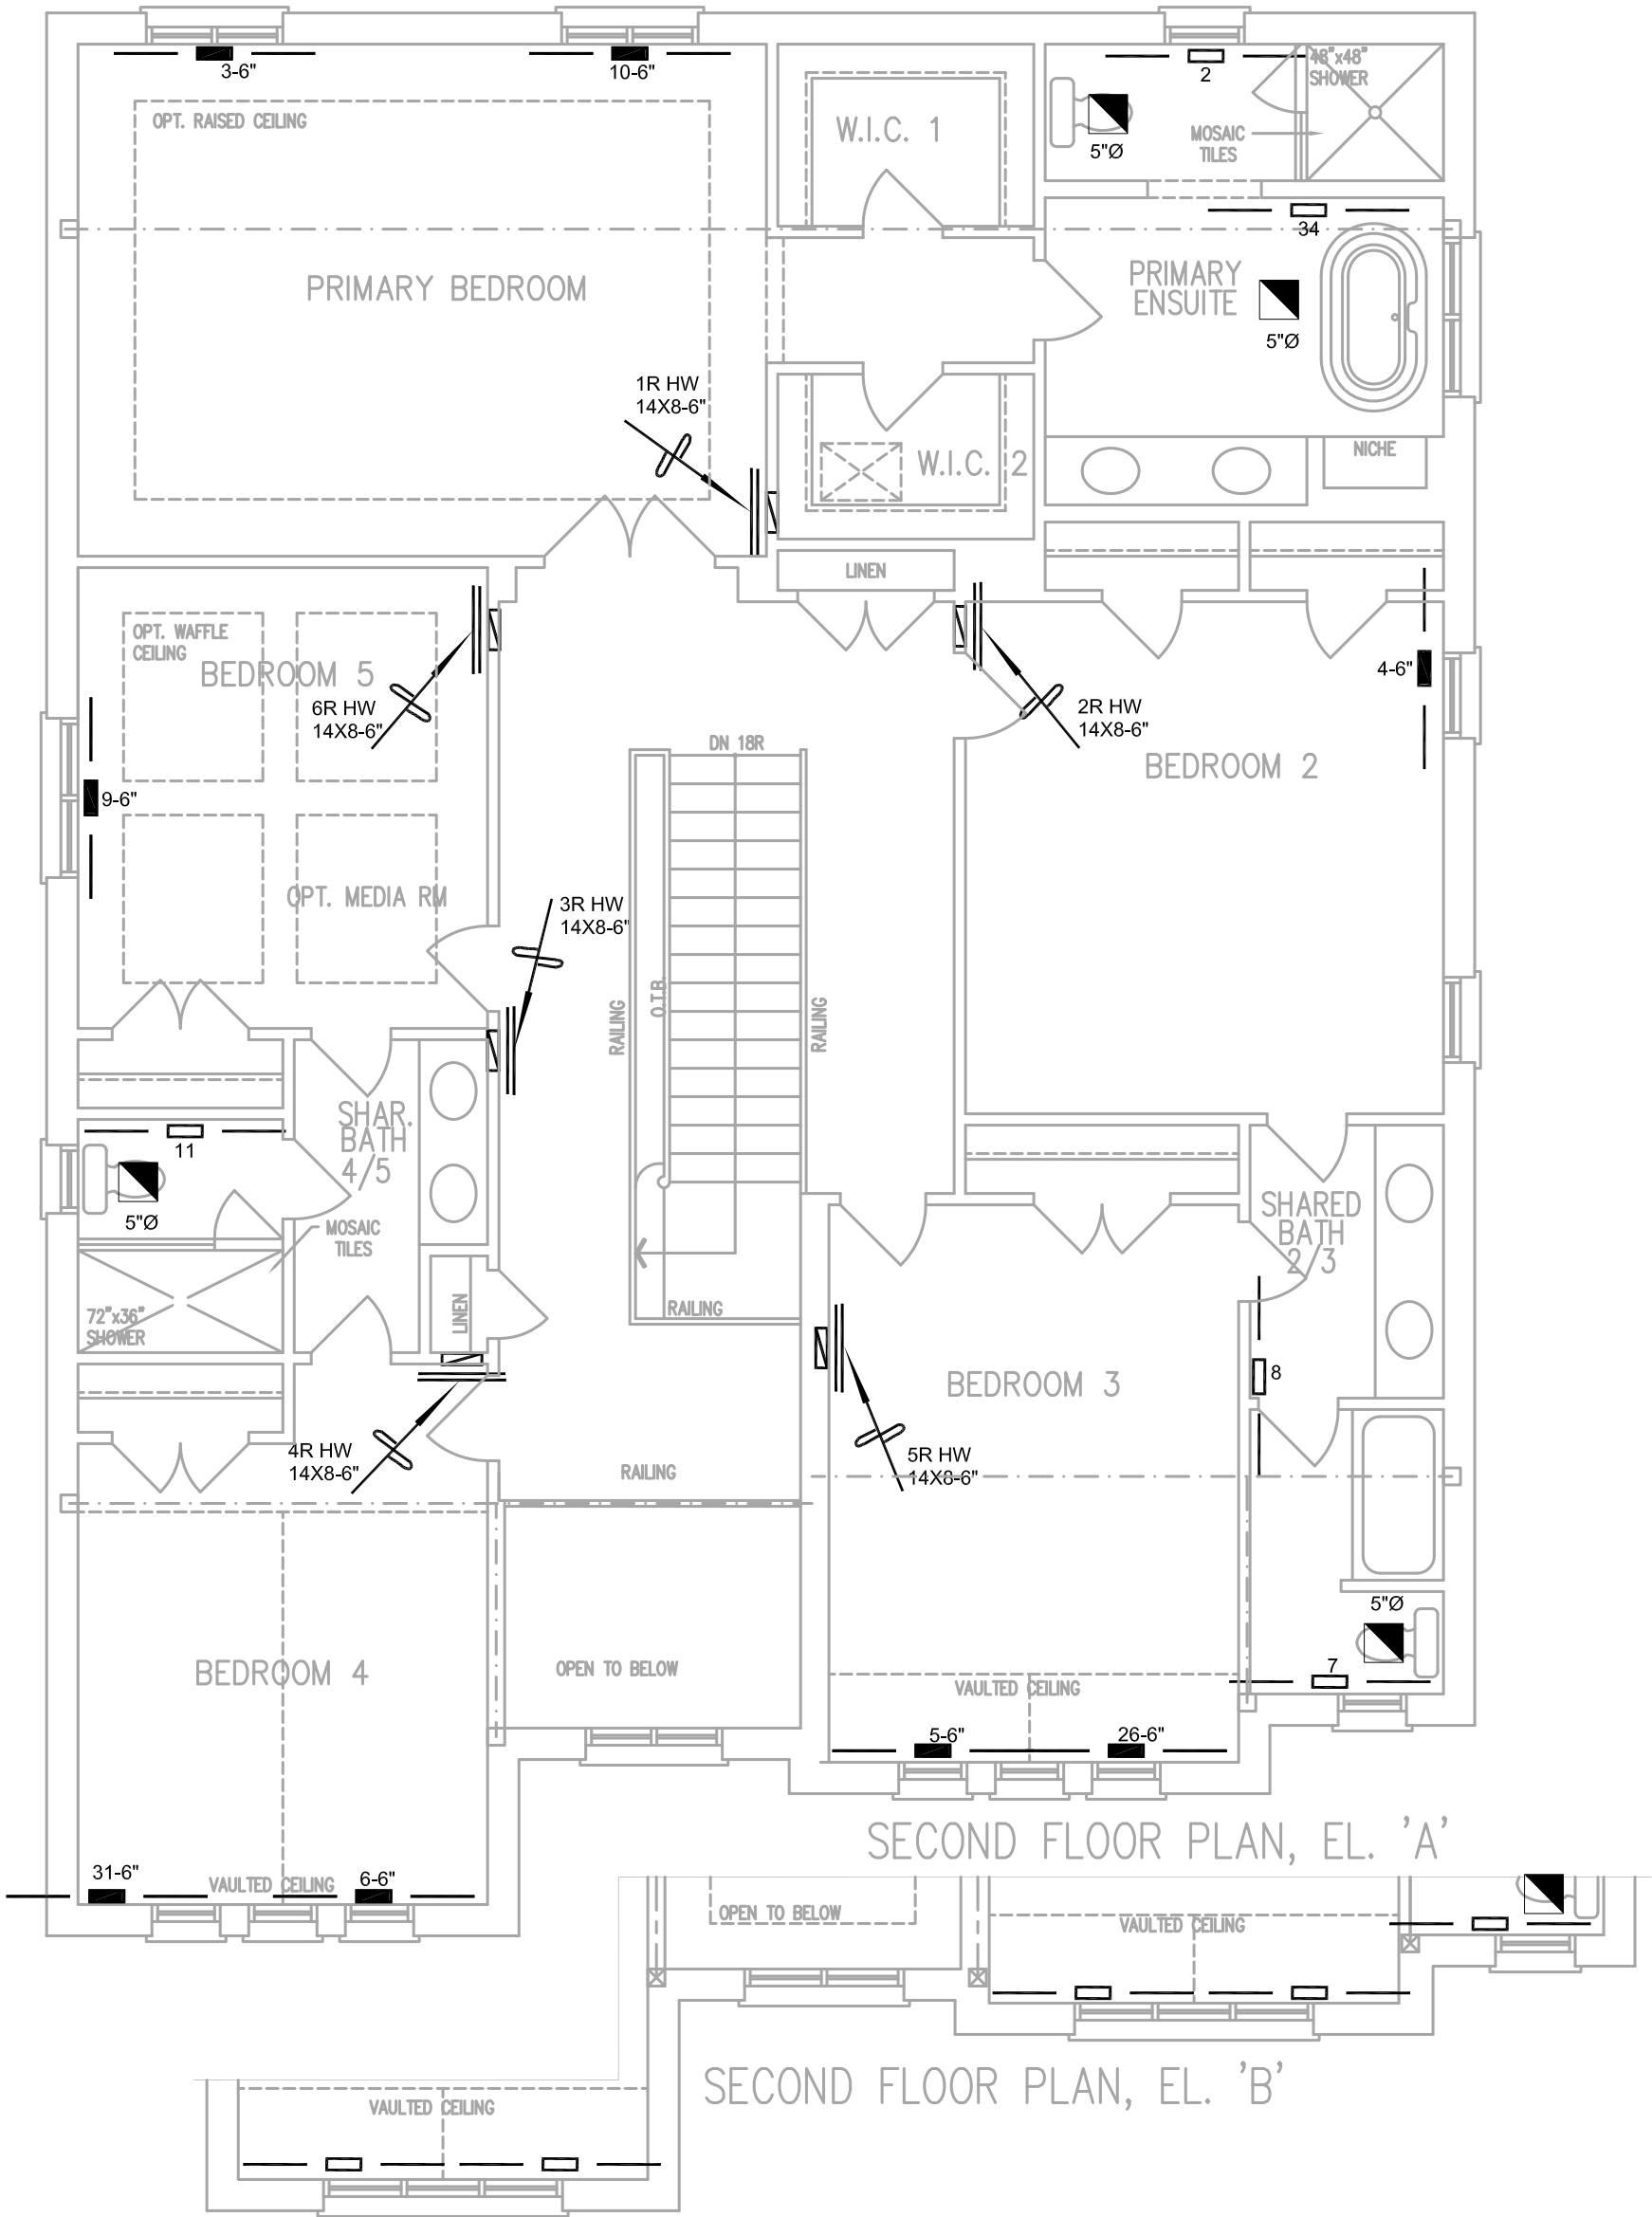

HVAC LEGEND								3.		
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.	UPDATED EQUIPMENT	JUL/2024
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.	REVISED TO PERFORMANCE PATH	MAR/2022
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description	Date
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	REVISIONS		
ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.						I Michael O'Rourke have reviewed and take responsibility for the design work and am qualified under division C.3.2.5 of the building code.		 Michael O'Rourke BCIN # 19669 HVAC Designs Ltd.		SB-12 PERFORMANCE
Client		 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdsgns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.				 Michael O'Rourke BCIN # 19669 HVAC Designs Ltd.				
Project Name										
ROYAL PINE HOMES										
VALES OF HUMBER SOUTH BRAMPTON, ONTARIO										
5003		4036 sqft				Sheet Title SECOND FLOOR HEATING LAYOUT				
						Date MAR/2022				
						Scale 3/16" = 1'-0"				
						BCIN# 19669				
						LO#		95281		