

Schedule 1: Designer Information

Use one form for each individual who reviews and takes responsibility for design activities with respect to the project.

A. Project Information					
Building number, street name				Unit no.	Lot/con.
Municipality BRAMPTON	Postal code	Plan number/ other description			
B. Individual who reviews and takes responsibility for design activities					
Name MICHAEL O'ROURKE		Firm HVAC DESIGNS LTD.			
Street address 375 FINLEY AVE			Unit no. 202	Lot/con. N/A	
Municipality AJAX	Postal code L1S 2E2	Province ONTARIO	E-mail info@hvacdesigns.ca		
Telephone number (905) 619-2300	Fax number (905) 619-2375	Cell number ()			
C. Design activities undertaken by individual identified in Section B. [Building Code Table 3.5.2.1 OF Division C]					
☐ House ☐ Small Buildings ☐ Large Buildings ☐ Complex Buildings		☒ HVAC - House ☐ Building Services ☐ Detection, Lighting and Power ☐ Fire Protection		☐ Building Structural ☐ Plumbing – House ☐ Plumbing – All Buildings ☐ On-site Sewage Systems	
Description of designer's work HEAT LOSS / GAIN CALCULATIONS DUCT SIZING RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY RESIDENTIAL SYSTEM DESIGN per CSA-F280-12			Model: 5008 - ELEV B OPT IN-LAW - 2ND Project: VALES OF HUMBER SOUTH		
D. Declaration of Designer					
I, <u>MICHAEL O'ROURKE</u> (print name)				declare that (choose one as appropriate):	
☐ I review and take responsibility for the design work on behalf of a firm registered under subsection 3.2.4. of Division C, of the Building Code. I am qualified, and the firm is registered, in the appropriate classes/categories. Individual BCIN: _____ Firm BCIN: _____					
☒ I review and take responsibility for the design and am qualified in the appropriate category as an "other designer" under subsection 3.2.5. of Division C, of the Building Code. Individual BCIN: <u>19669</u> Basis for exemption from registration and qualification: <u>O.B.C SENTENCE 3.2.4.1 (4)</u>					
☐ The design work is exempt from the registration and qualification requirements of the Building Code. Basis for exemption from registration and qualification: _____					
I certify that:					
1. The information contained in this schedule is true to the best of my knowledge. 2. I have submitted this application with the knowledge and consent of the firm.					
July 11, 2024					
Date			Signature of Designer		

NOTE:

- For the purposes of this form, "individual" means the "person" referred to in Clause 3.2.4.7(1) d) of Division C, Article 3.2.5.1. of Division C, and all other persons who are exempt from qualification under Subsections 3.2.4. and 3.2.5. of Division C.
- Schedule 1 is not required to be completed by a holder of a license, temporary license, or a certificate of authorization, issued by the Ontario Association of Architects. Schedule 1 is also not required to be completed by a holder of a license to practise, a limited license to practise, or a certificate of authorization, issued by the Association of Professional Engineers of Ontario.

Application for a Permit Construct or Demolish – Effective January 1, 2015

SITE NAME: VALES OF HUMBER SOUTH		OPT IN-LAW - 2ND		DATE Jul-24		WINTER NATURAL AIR CHANGE RATE 0.234		HEAT LOSS AT °F. 74		CSA-F280-12	
BUILDER: ROYAL PINE HOMES		TYPE: 5008 - ELEV B		GFA: 4398		LO# 95292		SUMMER NATURAL AIR CHANGE RATE 0.076		SB-12 PERFORMANCE	
ROOM USE		IN-LAW	GREAT	KIT	DIN	LIV	FOY	LAUN	I-ENS		
EXP. WALL		24	27	44	16	40	19	41	6		
CLG. HT.		11	11	11	11	11	21	13	11		
FACTORS											
GRS.WALL AREA	LOSS GAIN	264	297	484	176	440	399	533	66		
GLAZING	LOSS GAIN										
NORTH	20.8 15.5	0 0 0	12 249 186	0 0 0	0 0 0	0 0 0	0 0 0	16 332 248	8 166 124		
EAST	20.8 41.0	0 0 0	0 0 0	0 0 0	0 0 0	48 997 1970	46 956 1888	0 0 0	0 0 0		
SOUTH	20.8 24.4	0 0 0	12 249 293	42 873 1025	26 540 634	0 0 0	0 0 0	0 0 0	0 0 0		
WEST	20.8 41.0	36 748 1478	36 748 1478	71 1475 2914	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0		
SKYLT.	34.1 100.3	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0		
DOORS	24.7 3.7	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	30 740 110	25 616 91	0 0 0		
NET EXPOSED WALL	3.5 0.5	228 791 117	237 822 122	371 1286 191	150 520 77	392 1359 201	323 1120 166	492 1706 253	58 201 30		
NET EXPOSED BSMT WALL ABOVE GR	3.5 0.5	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0		
EXPOSED CLG	1.3 0.6	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0		
NO ATTIC EXPOSED CLG	2.7 1.2	0 0 0	10 27 12	0 0 0	0 0 0	20 54 24	56 150 67	0 0 0	0 0 0		
EXPOSED FLOOR	2.5 0.4	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0		
BASEMENT/CRAWL HEAT LOSS		0	0	0	0	0	0	0	0		
SLAB ON GRADE HEAT LOSS		0	0	0	0	0	0	0	0		
SUBTOTAL HT LOSS		1538	2095	3634	1060	2410	2965	2655	367		
SUB TOTAL HT GAIN			2090	4130	711	2196	2231	592	154		
LEVEL FACTOR / MULTIPLIER	0.30 0.36		0.30 0.36	0.30 0.36	0.30 0.36	0.30 0.36	0.30 0.36	0.30 0.36	0.30 0.36		
AIR CHANGE HEAT LOSS		559	762	1321	385	876	1078	965	134		
AIR CHANGE HEAT GAIN		93	121	240	41	127	129	34	9		
DUCT LOSS		0	0	0	0	0	0	0	0		
DUCT GAIN		0	0	0	0	0	0	0	0		
HEAT GAIN PEOPLE	240	1	240	0	0	0	0	0	0		
HEAT GAIN APPLIANCES/LIGHTS		693	693	693	693	693	693	693	693		
TOTAL HT LOSS BTU/H		2098	2857	4955	1446	3286	4043	3620	501		
TOTAL HT GAIN x 1.3 BTU/H		3406	3775	6581	1879	3921	3068	1715	211		

ROOM USE												BAS
EXP. WALL												222
CLG. HT.												10
FACTORS												
GRS.WALL AREA	LOSS GAIN											1554
GLAZING	LOSS GAIN											
NORTH	20.8 15.5											4 83 62
EAST	20.8 41.0											0 0 0
SOUTH	20.8 24.4											8 166 195
WEST	20.8 41.0											12 249 493
SKYLT.	34.1 100.3											0 0 0
DOORS	24.7 3.7											20 493 73
NET EXPOSED WALL	3.5 0.5											0 0 0
NET EXPOSED BSMT WALL ABOVE GR	3.5 0.5											666 2340 347
EXPOSED CLG	1.3 0.6											0 0 0
NO ATTIC EXPOSED CLG	2.7 1.2											0 0 0
EXPOSED FLOOR	2.5 0.4											0 0 0
BASEMENT/CRAWL HEAT LOSS												8044
SLAB ON GRADE HEAT LOSS												
SUBTOTAL HT LOSS												11375
SUB TOTAL HT GAIN												1170
LEVEL FACTOR / MULTIPLIER	0.50 0.89											
AIR CHANGE HEAT LOSS												10134
AIR CHANGE HEAT GAIN												68
DUCT LOSS												0
DUCT GAIN												0
HEAT GAIN PEOPLE	240											0
HEAT GAIN APPLIANCES/LIGHTS												0
TOTAL HT LOSS BTU/H												21509
TOTAL HT GAIN x 1.3 BTU/H												1609

TOTAL HEAT GAIN BTU/H: 49010 TONS: 4.08 LOSS DUE TO VENTILATION LOAD BTU/H: 6731 STRUCTURAL HEAT LOSS: 64501 TOTAL COMBINED HEAT LOSS BTU/H: 71232

SITE NAME: VALES OF HUMBER SOUTH						OPT IN-LAW - 2ND						DATE Jul-24						WINTER NATURAL AIR CHANGE RATE 0.234						HEAT LOSS AT °F. 74						CSA-F280-12											
BUILDER: ROYAL PINE HOMES						TYPE: 5008 - ELEV B						GFA: 4398						LO# 95292						SUMMER NATURAL AIR CHANGE RATE 0.076						HEAT GAIN ΔT °F. 11						SB-12 PERFORMANCE					
ROOM USE			PRI			ENS			BED-5			MEDIA			BED-2			BED-3			BATH-1			BED-4			BATH-2														
EXP. WALL			28			24			14			21			39			40			7			16			10														
CLG. HT.			9			9			9			9			10			10			9			9			9														
FACTORS																																									
GRS.WALL AREA			LOSS GAIN			252			216			126			189			390			400			63			144			90											
GLAZING			LOSS GAIN			LOSS GAIN			LOSS GAIN			LOSS GAIN			LOSS GAIN			LOSS GAIN			LOSS GAIN			LOSS GAIN			LOSS GAIN			LOSS GAIN											
NORTH			20.8	15.5	9	187	139	9	187	139	0	0	0	24	499	371	0	0	0	0	0	0	9	187	139	0	0	0	0	0	0										
EAST			20.8	41.0	0	0	0	0	0	0	0	0	0	0	0	0	55	1143	2258	42	873	1724	0	0	0	0	0	0	0	0	0										
SOUTH			20.8	24.4	9	187	220	0	0	0	18	374	439	0	0	0	0	0	0	0	0	0	0	0	18	374	439	0	0	0	0										
WEST			20.8	41.0	26	540	1067	18	374	739	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0										
SKYLT.			34.1	100.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0										
DOORS			24.7	3.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0									
NET EXPOSED WALL			3.5	0.5	208	721	107	189	655	97	108	374	56	165	572	85	335	1162	172	358	1241	184	54	187	28	126	437	65	90	312	46										
NET EXPOSED BSMT WALL ABOVE GR			3.5	0.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0									
EXPOSED CLG			1.3	0.6	404	506	225	143	179	80	210	263	117	441	553	246	306	383	171	260	326	145	84	105	47	320	401	178	150	188	84										
NO ATTIC EXPOSED CLG			2.7	1.2	0	0	0	0	0	0	0	0	0	0	0	0	30	81	36	75	201	90	0	0	0	0	0	0	0	0	0	0									
EXPOSED FLOOR			2.5	0.4	0	0	0	0	0	0	0	0	0	0	0	0	336	837	124	0	0	0	84	209	31	0	0	0	0	0	0	0									
BASEMENT/CRAWL HEAT LOSS			0			0			0			0			0			0			0			0			0			0			0			0					
SLAB ON GRADE HEAT LOSS			0			0			0			0			0			0			0			0			0			0			0			0					
SUBTOTAL HT LOSS			2142			1395			1012			1623			3605			2641			689			1212			500														
SUB TOTAL HT GAIN						1758			1055			612			702			2760			2142			245			682			130											
LEVEL FACTOR / MULTIPLIER			0.20	0.26				0.20	0.26				0.20	0.26				0.20	0.26				0.20	0.26				0.20	0.26												
AIR CHANGE HEAT LOSS			557			363			263			422			937			687			179			315			130														
AIR CHANGE HEAT GAIN			102			61			35			41			160			124			14			40			8														
DUCT LOSS			0			0			0			0			454			0			87			0			0														
DUCT GAIN			0			0			0			0			385			0			26			0			0														
HEAT GAIN PEOPLE			240		2	480	0	1	240	0	1	240	0	1	240	0	1	240	0	1	240	0	1	240	0	1	240	0	0	0	0	0	0	0							
HEAT GAIN APPLIANCES/LIGHTS			693			0			693			693			693			693			693			0			693			0											
TOTAL HT LOSS BTU/H			2698			1758			1275			2045			4996			3327			954			1527			630														
TOTAL HT GAIN x 1.3 BTU/H			3943			1451			2054			1866			5510			4159			370			2151			179														

ROOM USE	EXP. WALL	CLG. HT.	ENS-5																							
			17																							
			9																							
FACTORS																										
GRS.WALL AREA	LOSS	GAIN	153																							
GLAZING	LOSS	GAIN																								
NORTH	20.8	15.5	0	0	0																					
EAST	20.8	41.0	0	0	0																					
SOUTH	20.8	24.4	0	0	0																					
WEST	20.8	41.0	9	187	369																					
SKYLT.	34.1	100.3	0	0	0																					
DOORS	24.7	3.7	0	0	0																					
NET EXPOSED WALL	3.5	0.5	144	499	74																					
NET EXPOSED BSMT WALL ABOVE GR	3.5	0.5	0	0	0																					
EXPOSED CLG	1.3	0.6	70	88	39																					
NO ATTIC EXPOSED CLG	2.7	1.2	0	0	0																					
EXPOSED FLOOR	2.5	0.4	0	0	0																					
BASEMENT/CRAWL HEAT LOSS			0																							
SLAB ON GRADE HEAT LOSS			0																							
SUBTOTAL HT LOSS			774																							
SUB TOTAL HT GAIN				482																						
LEVEL FACTOR / MULTIPLIER	0.20	0.26																								
AIR CHANGE HEAT LOSS			201																							
AIR CHANGE HEAT GAIN				28																						
DUCT LOSS			0																							
DUCT GAIN			0																							
HEAT GAIN PEOPLE	240		0	0																						
HEAT GAIN APPLIANCES/LIGHTS				0																						
TOTAL HT LOSS BTU/H			975																							
TOTAL HT GAIN x 1.3 BTU/H				664																						

TOTAL HEAT GAIN BTU/H: 49010 TONS: 4.08 LOSS DUE TO VENTILATION LOAD BTU/H: 6731 STRUCTURAL HEAT LOSS: 64501 TOTAL COMBINED HEAT LOSS BTU/H: 71232

SITE NAME: VALES OF HUMBER SOUTH
BUILDER: ROYAL PINE HOMES

OPT IN-LAW - 2ND
TYPE: 5008 - ELEV B

DATE: Jul-24

GFA: 4398

LO# 95292

FURNACE 1

HEATING CFM 790
TOTAL HEAT LOSS 44,314
AIR FLOW RATE CFM 17.83
COOLING CFM 790
TOTAL HEAT GAIN 26,164
AIR FLOW RATE CFM 30.19

FACTORY
INSTALLED
furnace pressure 0.6
furnace filter 0.00
a/c coil pressure 0.25
available pressure for s/a & r/a 0.35

FURNACE HEAT LOSS +
HRV / ERV HEAT LOSS
= 47680 BTUH

CARRIER
59SC6A060M17--16
FAN SPEED LOW 0
MEDLOW 790
MEDIUM 975
MEDIUM HIGH 1140
HIGH 1300

AFUE = 97 %
INPUT (BTU/H) = 60,000
OUTPUT (BTU/H) = 58,000
DESIGN CFM = 790
CFM @ .6" E.S.P.
TEMPERATURE RISE 68 °F

RUN COUNT	4th	3rd	2nd	1st	Bas
S/A	0	0	0	15	7
R/A	0	0	0	3	1

All S/A diffusers 4"x10" unless noted otherwise on layout.

All S/A runs 5"Ø unless noted otherwise on layout.

RUN #	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	21	22	23	24
ROOM NAME	IN-LAW	IN-LAW	GREAT	GREAT	KIT	KIT	KIT	DIN	LIV	LIV	LIV	FOY	FOY	LAUN	I-ENS	BAS	BAS	BAS	BAS
RM LOSS MBH.	1.05	1.05	1.43	1.43	1.65	1.65	1.65	1.45	1.10	1.10	1.10	2.02	2.02	3.62	0.50	3.07	3.07	3.07	3.07
CFM PER RUN HEAT	19	19	25	25	29	29	29	26	20	20	20	36	36	65	9	55	55	55	55
RM GAIN MBH.	1.70	1.70	1.89	1.89	2.19	2.19	2.19	1.88	1.31	1.31	1.31	1.53	1.53	1.71	0.21	0.23	0.23	0.23	0.23
CFM PER RUN COOLING	51	51	57	57	66	66	66	57	39	39	39	46	46	52	6	7	7	7	7
ADJUSTED PRESSURE	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17
ACTUAL DUCT LGH.	47	41	39	25	24	30	20	31	48	43	38	44	39	42	36	23	31	37	26
EQUIVALENT LENGTH	160	150	160	140	110	110	100	100	120	110	100	130	100	160	100	100	140	100	110
TOTAL EFFECTIVE LENGTH	207	191	199	165	134	140	120	131	168	153	138	174	139	202	136	123	171	137	136
ADJUSTED PRESSURE	0.08	0.09	0.09	0.1	0.13	0.12	0.14	0.13	0.1	0.11	0.12	0.1	0.12	0.09	0.13	0.14	0.1	0.13	0.13
ROUND DUCT SIZE	4	5	6	6	6	6	6	4	4	4	4	5	5	5	4	4	5	4	4
HEATING VELOCITY (ft/min)	218	140	127	127	148	148	148	298	229	229	229	264	264	477	103	631	404	631	631
COOLING VELOCITY (ft/min)	585	374	291	291	337	337	337	654	447	447	447	338	338	382	69	80	51	80	80
OUTLET GRILL SIZE	3X10	3X10	4X10	4X10	4X10	4X10	4X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10
TRUNK	A	A	A	A	A	A	B	D	C	C	C	C	D	B	B	B	A	B	B

RUN #	25	26	27
ROOM NAME	BAS	BAS	BAS
RM LOSS MBH.	3.07	3.07	3.07
CFM PER RUN HEAT	55	55	55
RM GAIN MBH.	0.23	0.23	0.23
CFM PER RUN COOLING	7	7	7
ADJUSTED PRESSURE	0.17	0.17	0.17
ACTUAL DUCT LGH.	27	26	39
EQUIVALENT LENGTH	140	100	120
TOTAL EFFECTIVE LENGTH	167	126	159
ADJUSTED PRESSURE	0.1	0.14	0.11
ROUND DUCT SIZE	5	4	4
HEATING VELOCITY (ft/min)	404	631	631
COOLING VELOCITY (ft/min)	51	80	80
OUTLET GRILL SIZE	3X10	3X10	3X10
TRUNK	D	D	C

SUPPLY AIR TRUNK SIZE												RETURN AIR TRUNK SIZE											
	TRUNK CFM	STATIC PRESS.	ROUND DUCT	RECT DUCT		VELOCITY (ft/min)		TRUNK CFM	STATIC PRESS.	ROUND DUCT	RECT DUCT		VELOCITY (ft/min)		TRUNK CFM	STATIC PRESS.	ROUND DUCT	RECT DUCT		VELOCITY (ft/min)			
TRUNK A	201	0.08	7.7	10	x	8	362	TRUNK G	0	0.00	0	0	x	8	0	TRUNK O	0	0.07	0	0	x	8	0
TRUNK B	469	0.08	10.6	14	x	8	603	TRUNK H	0	0.00	0	0	x	8	0	TRUNK P	0	0.07	0	0	x	8	0
TRUNK C	151	0.10	6.5	8	x	8	340	TRUNK I	0	0.00	0	0	x	8	0	TRUNK Q	0	0.07	0	0	x	8	0
TRUNK D	323	0.10	8.7	12	x	8	485	TRUNK J	0	0.00	0	0	x	8	0	TRUNK R	0	0.07	0	0	x	8	0
TRUNK E	0	0.00	0	0	x	8	0	TRUNK K	0	0.00	0	0	x	8	0	TRUNK S	0	0.07	0	0	x	8	0
TRUNK F	0	0.00	0	0	x	8	0	TRUNK L	0	0.00	0	0	x	8	0	TRUNK T	0	0.07	0	0	x	8	0

RETURN AIR #	1	2	3													BR
AIR VOLUME	150	230	230	0	0	0	0	0	0	0	0	0	0	0	0	180
PLENUM PRESSURE	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15
ACTUAL DUCT LGH.	43	23	23	1	1	1	1	1	1	1	1	1	1	1	1	18
EQUIVALENT LENGTH	130	145	150	0	0	0	0	0	0	0	0	0	0	0	0	190
TOTAL EFFECTIVE LH	173	168	173	1	1	1	1	1	1	1	1	1	1	1	1	208
ADJUSTED PRESSURE	0.09	0.09	0.09	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	0.07	
ROUND DUCT SIZE	6.7	7.9	7.9	0	0	0	0	0	0	0	0	0	0	0	0	7.6
INLET GRILL SIZE	8	8	8	0	0	0	0	0	0	0	0	0	0	0	0	8
	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
INLET GRILL SIZE	14	24	24	0	0	0	0	0	0	0	0	0	0	0	0	24

SITE NAME: VALES OF HUMBER SOUTH
BUILDER: ROYAL PINE HOMES

OPT IN-LAW - 2ND
TYPE: 5008 - ELEV B

DATE: Jul-24

GFA: 4398

LO# 95292

FURNACE 2

HEATING CFM 770 COOLING CFM 770
TOTAL HEAT LOSS 20,186 TOTAL HEAT GAIN 22,346
AIR FLOW RATE CFM 38.14 AIR FLOW RATE CFM 34.46

FACTORY
INSTALLED
furnace pressure 0.6
furnace filter 0.00
a/c coil pressure 0.26
available pressure
for s/a & r/a 0.34

FURNACE HEAT LOSS +
HRV / ERV HEAT LOSS
= 23552 BTUH
CARRIER
59SC6A026M14--10
26
FAN SPEED
LOW 0
MEDLOW 545
MEDIUM 770
MEDIUM HIGH 0
HIGH 0

AFUE = 96 %
INPUT (BTU/H) = 26,000
OUTPUT (BTU/H) = **25,000**

DESIGN CFM = **770**
CFM @ .6" E.S.P.

TEMPERATURE RISE 30 °F

RUN COUNT	4th	3rd	2nd	1st	Bas
S/A	0	0	18	0	0
R/A	0	0	7	0	0

All S/A diffusers 4"x10" unless noted otherwise on layout.

All S/A runs 5"Ø unless noted otherwise on layout.

RUN #	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18
ROOM NAME	ENS-5	PRI	PRI	ENS	MEDIA	MEDIA	BATH-1	BED-2	BED-2	BED-2	BED-3	BED-3	BATH-2	BED-4	BED-4	BATH-1	BED-5	BED-5
RM LOSS MBH.	0.98	1.35	1.35	1.76	1.02	1.02	0.48	1.67	1.67	1.67	1.66	1.66	0.63	0.76	0.76	0.48	0.64	0.64
CFM PER RUN HEAT	37	51	51	67	39	39	18	64	64	64	63	63	24	29	29	18	24	24
RM GAIN MBH.	0.66	1.97	1.97	1.45	0.93	0.93	0.19	1.84	1.84	1.84	2.08	2.08	0.18	1.08	1.08	0.19	1.03	1.03
CFM PER RUN COOLING	23	68	68	50	32	32	6	63	63	63	72	72	6	37	37	6	35	35
ADJUSTED PRESSURE	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17
ACTUAL DUCT LGH.	41	69	53	58	56	54	59	58	62	68	62	59	57	67	31	60	49	44
EQUIVALENT LENGTH	160	150	140	160	170	190	140	140	140	110	170	150	110	150	160	140	170	170
TOTAL EFFECTIVE LENGTH	201	219	193	218	226	244	199	198	202	178	232	209	167	217	191	200	219	214
ADJUSTED PRESSURE	0.08	0.08	0.09	0.08	0.07	0.07	0.08	0.08	0.08	0.09	0.07	0.08	0.1	0.08	0.09	0.08	0.08	0.08
ROUND DUCT SIZE	4	6	6	5	5	5	4	5	5	5	6	6	4	4	4	4	4	4
HEATING VELOCITY (ft/min)	424	260	260	492	286	286	207	470	470	470	321	321	275	333	333	207	275	275
COOLING VELOCITY (ft/min)	264	347	347	367	235	235	69	463	463	463	367	367	69	424	424	69	402	402
OUTLET GRILL SIZE	3X10	4X10	4X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	4X10	4X10	3X10	3X10	3X10	3X10	3X10	3X10
TRUNK	C	C	C	C	C	C	B	A	A	B	A	A	B	B	B	B	C	C

RUN #	ROOM NAME	RM LOSS MBH.	CFM PER RUN HEAT	RM GAIN MBH.	CFM PER RUN COOLING	ADJUSTED PRESSURE	ACTUAL DUCT LGH.	EQUIVALENT LENGTH	TOTAL EFFECTIVE LENGTH	ADJUSTED PRESSURE	ROUND DUCT SIZE	HEATING VELOCITY (ft/min)	COOLING VELOCITY (ft/min)	OUTLET GRILL SIZE	TRUNK
1	ENS-5	0.98	37	0.66	23	0.17	41	160	201	0.08	4	424	264	3X10	C
2	PRI	1.35	51	1.97	68	0.17	69	150	219	0.08	6	260	347	4X10	C
3	PRI	1.35	51	1.97	68	0.17	53	140	193	0.09	6	260	347	4X10	C
4	ENS	1.76	67	1.45	50	0.17	58	160	218	0.08	5	492	367	3X10	C
5	MEDIA	1.02	39	0.93	32	0.17	56	170	226	0.07	5	286	235	3X10	C
6	MEDIA	1.02	39	0.93	32	0.17	54	190	244	0.07	5	286	235	3X10	C
7	BATH-1	0.48	18	0.19	6	0.17	59	140	199	0.08	4	207	69	3X10	B
8	BED-2	1.67	64	1.84	63	0.17	58	140	198	0.08	5	470	463	3X10	A
9	BED-2	1.67	64	1.84	63	0.17	62	140	202	0.08	5	470	463	3X10	A
10	BED-2	1.67	64	1.84	63	0.17	68	110	178	0.09	5	470	463	3X10	B
11	BED-3	1.66	63	2.08	72	0.17	62	170	232	0.07	6	321	367	4X10	A
12	BED-3	1.66	63	2.08	72	0.17	59	150	209	0.08	6	321	367	4X10	A
13	BATH-2	0.63	24	0.18	6	0.17	57	110	167	0.1	4	275	69	3X10	B
14	BED-4	0.76	29	1.08	37	0.17	67	150	217	0.08	4	333	424	3X10	B
15	BED-4	0.76	29	1.08	37	0.17	31	160	191	0.09	4	333	424	3X10	B
16	BATH-1	0.48	18	0.19	6	0.17	60	140	200	0.08	4	207	69	3X10	B
17	BED-5	0.64	24	1.03	35	0.17	49	170	219	0.08	4	275	402	3X10	C
18	BED-5	0.64	24	1.03	35	0.17	44	170	214	0.08	4	275	402	3X10	C

SUPPLY AIR TRUNK SIZE															RETURN AIR TRUNK SIZE														
	TRUNK	STATIC	ROUND	RECT			VELOCITY			TRUNK	STATIC	ROUND	RECT	VELOCITY		TRUNK	STATIC	ROUND	RECT	VELOCITY									
	CFM	PRESS.	DUCT	DUCT			(ft/min)			CFM	PRESS.	DUCT	DUCT	(ft/min)		CFM	PRESS.	DUCT	DUCT	(ft/min)									
TRUNK A	254	0.07	8.7	10	x	8	457			TRUNK G	0	0.00	0	0	x	8	0			0									
TRUNK B	436	0.07	10.6	14	x	8	561			TRUNK H	0	0.00	0	0	x	8	0			0									
TRUNK C	332	0.07	9.6	12	x	8	498			TRUNK I	0	0.00	0	0	x	8	0			0									
TRUNK D	0	0.00	0	0	x	8	0			TRUNK J	0	0.00	0	0	x	8	0			0									
TRUNK E	0	0.00	0	0	x	8	0			TRUNK K	0	0.00	0	0	x	8	0			0									
TRUNK F	0	0.00	0	0	x	8	0			TRUNK L	0	0.00	0	0	x	8	0			0									

RETURN AIR #	1	2	3	4	5	6	7									BR
AIR VOLUME	120	120	125	115	85	105	100	0	0	0	0	0	0	0	0	0
PLENUM PRESSURE	0.14	0.14	0.14	0.14	0.14	0.14	0.14	0.14	0.14	0.14	0.14	0.14	0.14	0.14	0.14	0.14
ACTUAL DUCT LGH.	62	57	61	82	66	64	58	1	1	1	1	1	1	1	1	1
EQUIVALENT LENGTH	180	175	175	220	215	215	165	0	0	0	0	0	0	0	0	0
TOTAL EFFECTIVE LH	242	232	236	302	281	279	223	1	1	1	1	1	1	1	1	1
ADJUSTED PRESSURE	0.06	0.06	0.06	0.05	0.05	0.05	0.06	14.32	14.32	14.32	14.32	14.32	14.32	14.32	14.32	14.32
ROUND DUCT SIZE	6.8	6.8	6.9	7	6.3	6.8	6.4	0	0	0	0	0	0	0	0	0
INLET GRILL SIZE	8	8	8	8	8	8	8	0	0	0	0	0	0	0	0	0
	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
INLET GRILL SIZE	14	14	14	14	14	14	14	0	0	0	0	0	0	0	0	0

TYPE: 5008 - ELEV B
SITE NAME: VALES OF HUMBER SOUTH

LO # 95292
OPT IN-LAW - 2ND

RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY

COMBUSTION APPLIANCES		9.32.3.1(1)
a)	☒ Direct vent (sealed combustion) only	
b)	☐ Positive venting induced draft (except fireplaces)	
c)	☐ Natural draft, B-vent or induced draft gas fireplace	
d)	☐ Solid Fuel (including fireplaces)	
e)	☐ No Combustion Appliances	

HEATING SYSTEM	
☒ Forced Air	☐ Non Forced Air
☐ Electric Space Heat	

HOUSE TYPE		9.32.1(2)
☒ I	Type a) or b) appliance only, no solid fuel	
☐ II	Type I except with solid fuel (including fireplaces)	
☐ III	Any Type c) appliance	
☐ IV	Type I, or II with electric space heat	
☐	Other: Type I, II or IV no forced air	

SYSTEM DESIGN OPTIONS		O.N.H.W.P.
☐ 1	Exhaust only/Forced Air System	
☐ 2	HRV with Ducting/Forced Air System	
☒ 3	HRV Simplified/connected to forced air system	
☐ 4	HRV with Ducting/non forced air system	
☐	Part 6 Design	

TOTAL VENTILATION CAPACITY		9.32.3.3(1)
Basement + Master Bedroom	<u>2</u> @ 21.2 cfm <u>42.4</u> cfm	
Other Bedrooms	<u>5</u> @ 10.6 cfm <u>53</u> cfm	
Kitchen & Bathrooms	<u>7</u> @ 10.6 cfm <u>74.2</u> cfm	
Other Rooms	<u>6</u> @ 10.6 cfm <u>63.6</u> cfm	
Table 9.32.3.A.	TOTAL <u>233.2</u> cfm	

PRINCIPAL VENTILATION CAPACITY REQUIRED		9.32.3.4.(1)
6 Bedrooms		
As Per Ashrea 62.2 Dwelling- Unit Ventilation		
4.1.1 Total Ventilation Rate		
$Q_{tot}=0.03A_{floor}+7.5(N_{br}+1)$		
TOTAL <u>184.4</u> cfm		

SUPPLEMENTAL VENTILATION CAPACITY		9.32.3.5.
Total Ventilation Capacity	<u>233.2</u>	cfm
Less Principal Ventil. Capacity	<u>210</u>	cfm
Required Supplemental Capacity	<u>23.2</u>	cfm

PRINCIPAL EXHAUST FAN CAPACITY	
Model:	VANEE G2400H ECM Location: BSMT
<u>210.0</u> cfm	☒ HVI Approved

PRINCIPAL EXHAUST HEAT LOSS CALCULATION				
CFM	ΔT °F	FACTOR	% LOSS	
210.0 CFM	X 74 F	X 1.08	X	0.20

SUPPLEMENTAL FANS		BY INSTALLING CONTRACTOR		
Location	Model	cfm	HVI	Sones
ENS	BY INSTALLING CONTRACTOR	50	☒	3.5
BATH-1	BY INSTALLING CONTRACTOR	50	☒	3.5
BATH-2	BY INSTALLING CONTRACTOR	50	☒	3.5
BATH-3	BY INSTALLING CONTRACTOR	50	☒	3.5

HEAT RECOVERY VENTILATOR		9.32.3.11.
Model:	VANEE G2400H ECM	INSTALL 2 HRV / ERV's
<u>210</u>	cfm high	<u>50</u> cfm low
<u>80</u>	% Sensible Efficiency @ 32 deg F (0 deg C)	☒ HVI Approved

LOCATION OF INSTALLATION	
Lot:	Concession
Township	Plan:
Address	
Roll #	Building Permit #

BUILDER:	
ROYAL PINE HOMES	
Name:	
Address:	
City:	
Telephone #:	Fax #:

INSTALLING CONTRACTOR	
Name:	
Address:	
City:	
Telephone #:	Fax #:

DESIGNER CERTIFICATION	
I hereby certify that this ventilation system has been designed in accordance with the Ontario Building Code.	
Name:	HVAC Designs Ltd.
Signature:	<i>Michael O'Rourke</i>
HRAI #	001820
Date:	July-24

CSA F280-12 Residential Heat Loss and Heat Gain Calculations																																																												
Formula Sheet (For Air Leakage / Ventilation Calculation)																																																												
LO#: 95292	Model: 5008 - ELEV B	Builder: ROYAL PINE HOMES	Date: 7/11/2024																																																									
Volume Calculation			Air Change & Delta T Data																																																									
House Volume <table border="1" style="width:100%; border-collapse: collapse; margin-top: 5px;"> <thead> <tr> <th>Level</th> <th>Floor Area (ft²)</th> <th>Floor Height (ft)</th> <th>Volume (ft³)</th> </tr> </thead> <tbody> <tr><td>Bsmt</td><td>2073</td><td>10</td><td>20730</td></tr> <tr><td>First</td><td>2073</td><td>11</td><td>22803</td></tr> <tr><td>Second</td><td>2400</td><td>9</td><td>21600</td></tr> <tr><td>Third</td><td>0</td><td>9</td><td>0</td></tr> <tr><td>Fourth</td><td>0</td><td>9</td><td>0</td></tr> <tr><td colspan="3" style="text-align: right;">Total:</td><td>65,133.0 ft³</td></tr> <tr><td colspan="3" style="text-align: right;">Total:</td><td>1844.4 m³</td></tr> </tbody> </table>			Level	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)	Bsmt	2073	10	20730	First	2073	11	22803	Second	2400	9	21600	Third	0	9	0	Fourth	0	9	0	Total:			65,133.0 ft³	Total:			1844.4 m³	<table border="1" style="width:100%; border-collapse: collapse; margin-top: 5px;"> <tr> <td style="width: 70%;">WINTER NATURAL AIR CHANGE RATE</td> <td style="width: 30%; text-align: center;">0.234</td> </tr> <tr> <td>SUMMER NATURAL AIR CHANGE RATE</td> <td style="text-align: center;">0.076</td> </tr> </table> <table border="1" style="width:100%; border-collapse: collapse; margin-top: 5px;"> <tr> <th colspan="5" style="text-align: center;">Design Temperature Difference</th> </tr> <tr> <th></th> <th>Tin °C</th> <th>Tout °C</th> <th>ΔT °C</th> <th>ΔT °F</th> </tr> <tr> <td>Winter DTDh</td> <td style="text-align: center;">22</td> <td style="text-align: center;">-19</td> <td style="text-align: center;">41</td> <td style="text-align: center;">74</td> </tr> <tr> <td>Summer DTDc</td> <td style="text-align: center;">24</td> <td style="text-align: center;">30</td> <td style="text-align: center;">6</td> <td style="text-align: center;">11</td> </tr> </table>		WINTER NATURAL AIR CHANGE RATE	0.234	SUMMER NATURAL AIR CHANGE RATE	0.076	Design Temperature Difference						Tin °C	Tout °C	ΔT °C	ΔT °F	Winter DTDh	22	-19	41	74	Summer DTDc	24	30	6	11
Level	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)																																																									
Bsmt	2073	10	20730																																																									
First	2073	11	22803																																																									
Second	2400	9	21600																																																									
Third	0	9	0																																																									
Fourth	0	9	0																																																									
Total:			65,133.0 ft³																																																									
Total:			1844.4 m³																																																									
WINTER NATURAL AIR CHANGE RATE	0.234																																																											
SUMMER NATURAL AIR CHANGE RATE	0.076																																																											
Design Temperature Difference																																																												
	Tin °C	Tout °C	ΔT °C	ΔT °F																																																								
Winter DTDh	22	-19	41	74																																																								
Summer DTDc	24	30	6	11																																																								
5.2.3.1 Heat Loss due to Air Leakage			6.2.6 Sensible Gain due to Air Leakage																																																									
$HL_{airb} = LR_{airh} \times \frac{V_b}{3.6} \times DTD_h \times 1.2$ 0.234 x 512.32 x 41 °C x 1.2 = 5940 W = 20268 Btu/h			$HG_{salb} = LR_{airc} \times \frac{V_b}{3.6} \times DTD_c \times 1.2$ = 0.076 x 512.32 x 6 °C x 1.2 = 286 W = 977 Btu/h																																																									
5.2.3.2 Heat Loss due to Mechanical Ventilation			6.2.7 Sensible heat Gain due to Ventilation																																																									
$HL_{vairb} = PVC \times DTD_h \times 1.08 \times (1 - E) \times 2 \text{ HRV / ERV's}$ 420 CFM x 74 °F x 1.08 x 0.20 = 6731 Btu/h			$HL_{vairb} = PVC \times DTD_h \times 1.08 \times (1 - E)$ 420 CFM x 11 °F x 1.08 x 0.20 = 998 Btu/h																																																									
5.2.3.3 Calculation of Air Change Heat Loss for Each Room (Floor Multiplier Section)																																																												
$HL_{airr} = Level \ Factor \times HL_{airbv} \times \{(HL_{agcr} + HL_{bgcr}) \div (HL_{agclevel} + HL_{bgclevel})\}$																																																												
Level	Level Factor (LF)	HLairve Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{clevel})	Air Leakage Heat Loss Multiplier (LF x HLairbv / HL _{clevel})																																																								
1	0.5	20,268	11,375	0.891																																																								
2	0.3		16,725	0.364																																																								
3	0.2		15,592	0.260																																																								
4	0		0	0.000																																																								
5	0		0	0.000																																																								
*HLairbv = Air leakage heat loss + ventilation heat loss *For a balanced or supply only ventilation system HLairve = 0																																																												
				Michael O'Rourke BCIN# 19669 																																																								

HEAT LOSS AND GAIN SUMMARY SHEET

MODEL: 5008 - ELEV B	OPT IN-LAW - 2ND	BUILDER: ROYAL PINE HOMES
SFQT: 4398	LO# 95292	SITE: VALES OF HUMBER SOUTH

DESIGN ASSUMPTIONS

HEATING	°F	COOLING	°F
OUTDOOR DESIGN TEMP.	-2	OUTDOOR DESIGN TEMP.	86
INDOOR DESIGN TEMP.	72	INDOOR DESIGN TEMP. (MAX 75°F)	75
		WINDOW SHGC	0.60

BUILDING DATA

ATTACHMENT:	DETACHED	# OF STORIES (+BASEMENT):	3
FRONT FACES:	EAST	ASSUMED (Y/N):	Y
AIR CHANGES PER HOUR:	2.50	ASSUMED (Y/N):	Y
AIR TIGHTNESS CATEGORY:	TIGHT	ASSUMED (Y/N):	Y
WIND EXPOSURE:	SHELTERED	ASSUMED (Y/N):	Y
HOUSE VOLUME (ft ³):	65133.0	ASSUMED (Y/N):	Y
INTERNAL SHADING:	BLINDS/CURTAINS	ASSUMED OCCUPANTS:	7
INTERIOR LIGHTING LOAD (Btu/h/ft ²):	1.27	DC BRUSHLESS MOTOR (Y/N):	Y
FOUNDATION CONFIGURATION	BCIN_1	DEPTH BELOW GRADE:	7.0 ft
LENGTH: 69.0 ft	WIDTH: 42.0 ft	EXPOSED PERIMETER:	222.0 ft

2012 OBC - COMPLIANCE PACKAGE**Component****Compliance Package
SB-12 PERFORMANCE****Nominal Min. Eff.**

Ceiling with Attic Space Minimum RSI (R)-Value	60	59.22
Ceiling Without Attic Space Minimum RSI (R)-Value	31	27.65
Exposed Floor Minimum RSI (R)-Value	31	29.80
Walls Above Grade Minimum RSI (R)-Value	22+1.5	21.40
Basement Walls Minimum RSI (R)-Value	20	21.12
Below Grade Slab Entire surface > 600 mm below grade Minimum RSI (R)-Value	-	-
Edge of Below Grade Slab ≤ 600 mm Below Grade Minimum RSI (R)-Value	10	10
Heated Slab or Slab ≤ 600 mm below grade Minimum RSI (R)-Value	10	11.13
Windows and Sliding Glass Doors Maximum U-Value	1.6	-
Skylights Maximum U-Value	2.6	-
Space Heating Equipment Minimum AFUE	0.96	-
HRV Minimum Efficiency	75%	-
Domestic Hot Water Heater Minimum EF	0.9	-


INDIVIDUAL BCIN: 19669

MICHAEL O'ROURKE



Residential Foundation Thermal Load Calculator

Supplemental tool for CAN/CSA-F280

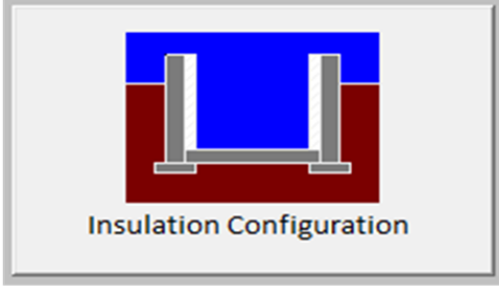Weather Station Description		
Province:	Ontario	
Region:	Brampton	
Site Description		
Soil Conductivity:	Normal conductivity: dry sand, loam, clay	
Water Table:	Normal (7-10 m, 23-33 ft)	
Foundation Dimensions		
Floor Length (m):	21.0	
Floor Width (m):	12.8	
Exposed Perimeter (m):	0.0	
Wall Height (m):	3.0	
Depth Below Grade (m):	2.13	
Window Area (m ²):	2.2	
Door Area (m ²):	1.9	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	33	
Design Months		
Heating Month	1	
Foundation Loads		
Heating Load (Watts):		2357

TYPE: 5008 - ELEV B
LO# 95292

OPT IN-LAW - 2ND


Air Infiltration Residential Load Calculator

Supplemental tool for CAN/CSA-F280

Weather Station Description				
Province:	Ontario			
Region:	Brampton			
Weather Station Location:	Open flat terrain, grass			
Anemometer height (m):	10			
Local Shielding				
Building Site:	Suburban, forest			
Walls:	Heavy			
Flue:	Heavy			
Highest Ceiling Height (m):	7.01			
Building Configuration				
Type:	Detached			
Number of Stories:	Two			
Foundation:	Full			
House Volume (m ³):	1844.4			
Air Leakage/Ventilation				
Air Tightness Type:	Energy Star Detached (2.5 ACH)			
Custom BDT Data:	ELA @ 10 Pa.		1721.7 cm ²	
	2.50		ACH @ 50 Pa	
Mechanical Ventilation (L/s):	Total Supply		Total Exhaust	
	99.1		99.1	
Flue Size				
Flue #:	#1	#2	#3	#4
Diameter (mm):	0	0	0	0
Natural Infiltration Rates				
Heating Air Leakage Rate (ACH/H):	0.234			
Cooling Air Leakage Rate (ACH/H):	0.076			

TYPE: 5008 - ELEV B
LO# 95292

OPT IN-LAW - 2ND

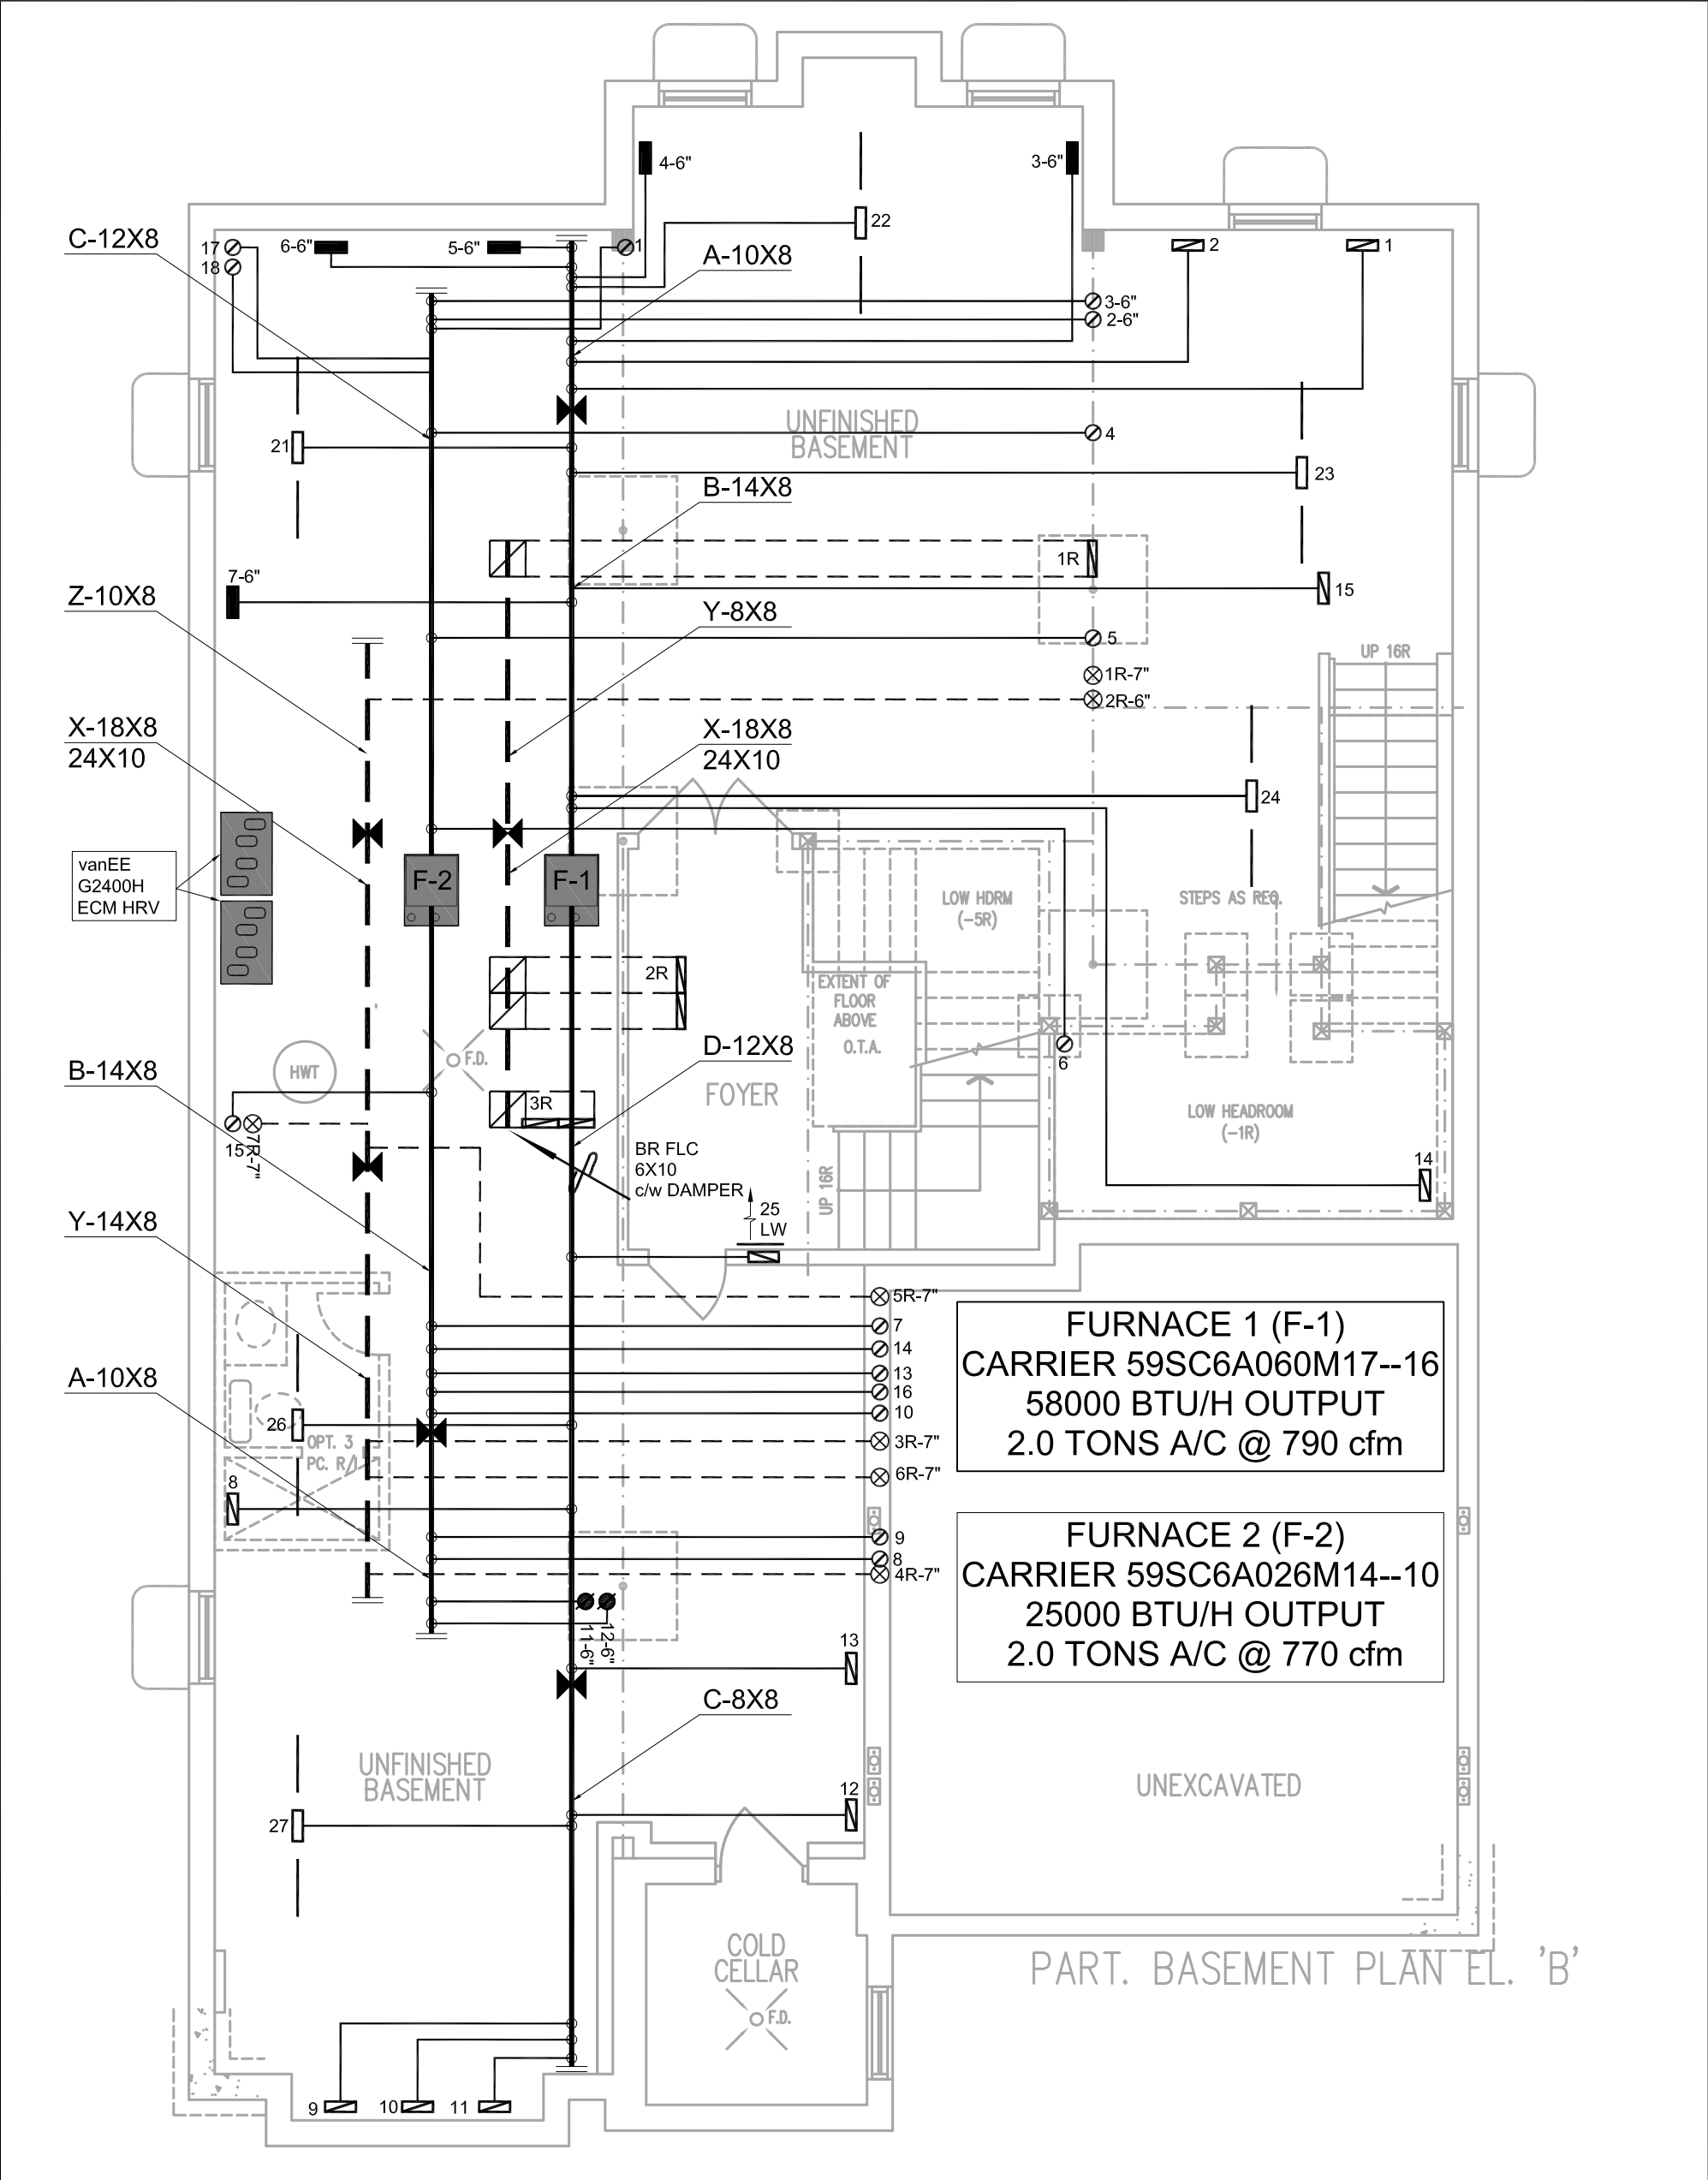

HVAC LEGEND								3.		
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	2.	REVISED EQUIPMENT	JULY/24
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	1.	REVISED TO PERFORMANCE PATH	APR/2022
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	No.	Description	Date
								REVISIONS		
ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.								I Michael O'Rourke have reviewed and take responsibility for the design work and am qualified under division C.3.2.5 of the building code. Michael O'Rourke BCIN # 19669 HVAC Designs Ltd.		
Client		ROYAL PINE HOMES				SB-12 PERFORMANCE			Sheet Title	
Project Name		VALES OF HUMBER SOUTH BRAMPTON, ONTARIO				BASEMENT HEATING LAYOUT			Date	MAR/2022
OPT IN-LAW - 2ND		5008 - ELEV B 4398 sqft				Scale			3/16" = 1'-0"	
						BCIN# 19669				
						LO# 95292				

	S/A	R/A	FANS
2ND	18	7	4
1ST	15	3	3
BAS	7	1	0

375 Finley Ave. Suite 202 - Ajax, Ontario
L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375
Email: info@hvacdsgns.ca
Web: www.hvacdsgns.ca
Specializing in Residential Mechanical Design Services
Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.



REVISIONS


I Michael O'Rourke have reviewed and take responsibility for the design work and am qualified under division C.3.2.5 of the building code.

SB-12 PERFORMANCE

Sheet Title

Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.

LO# 95292

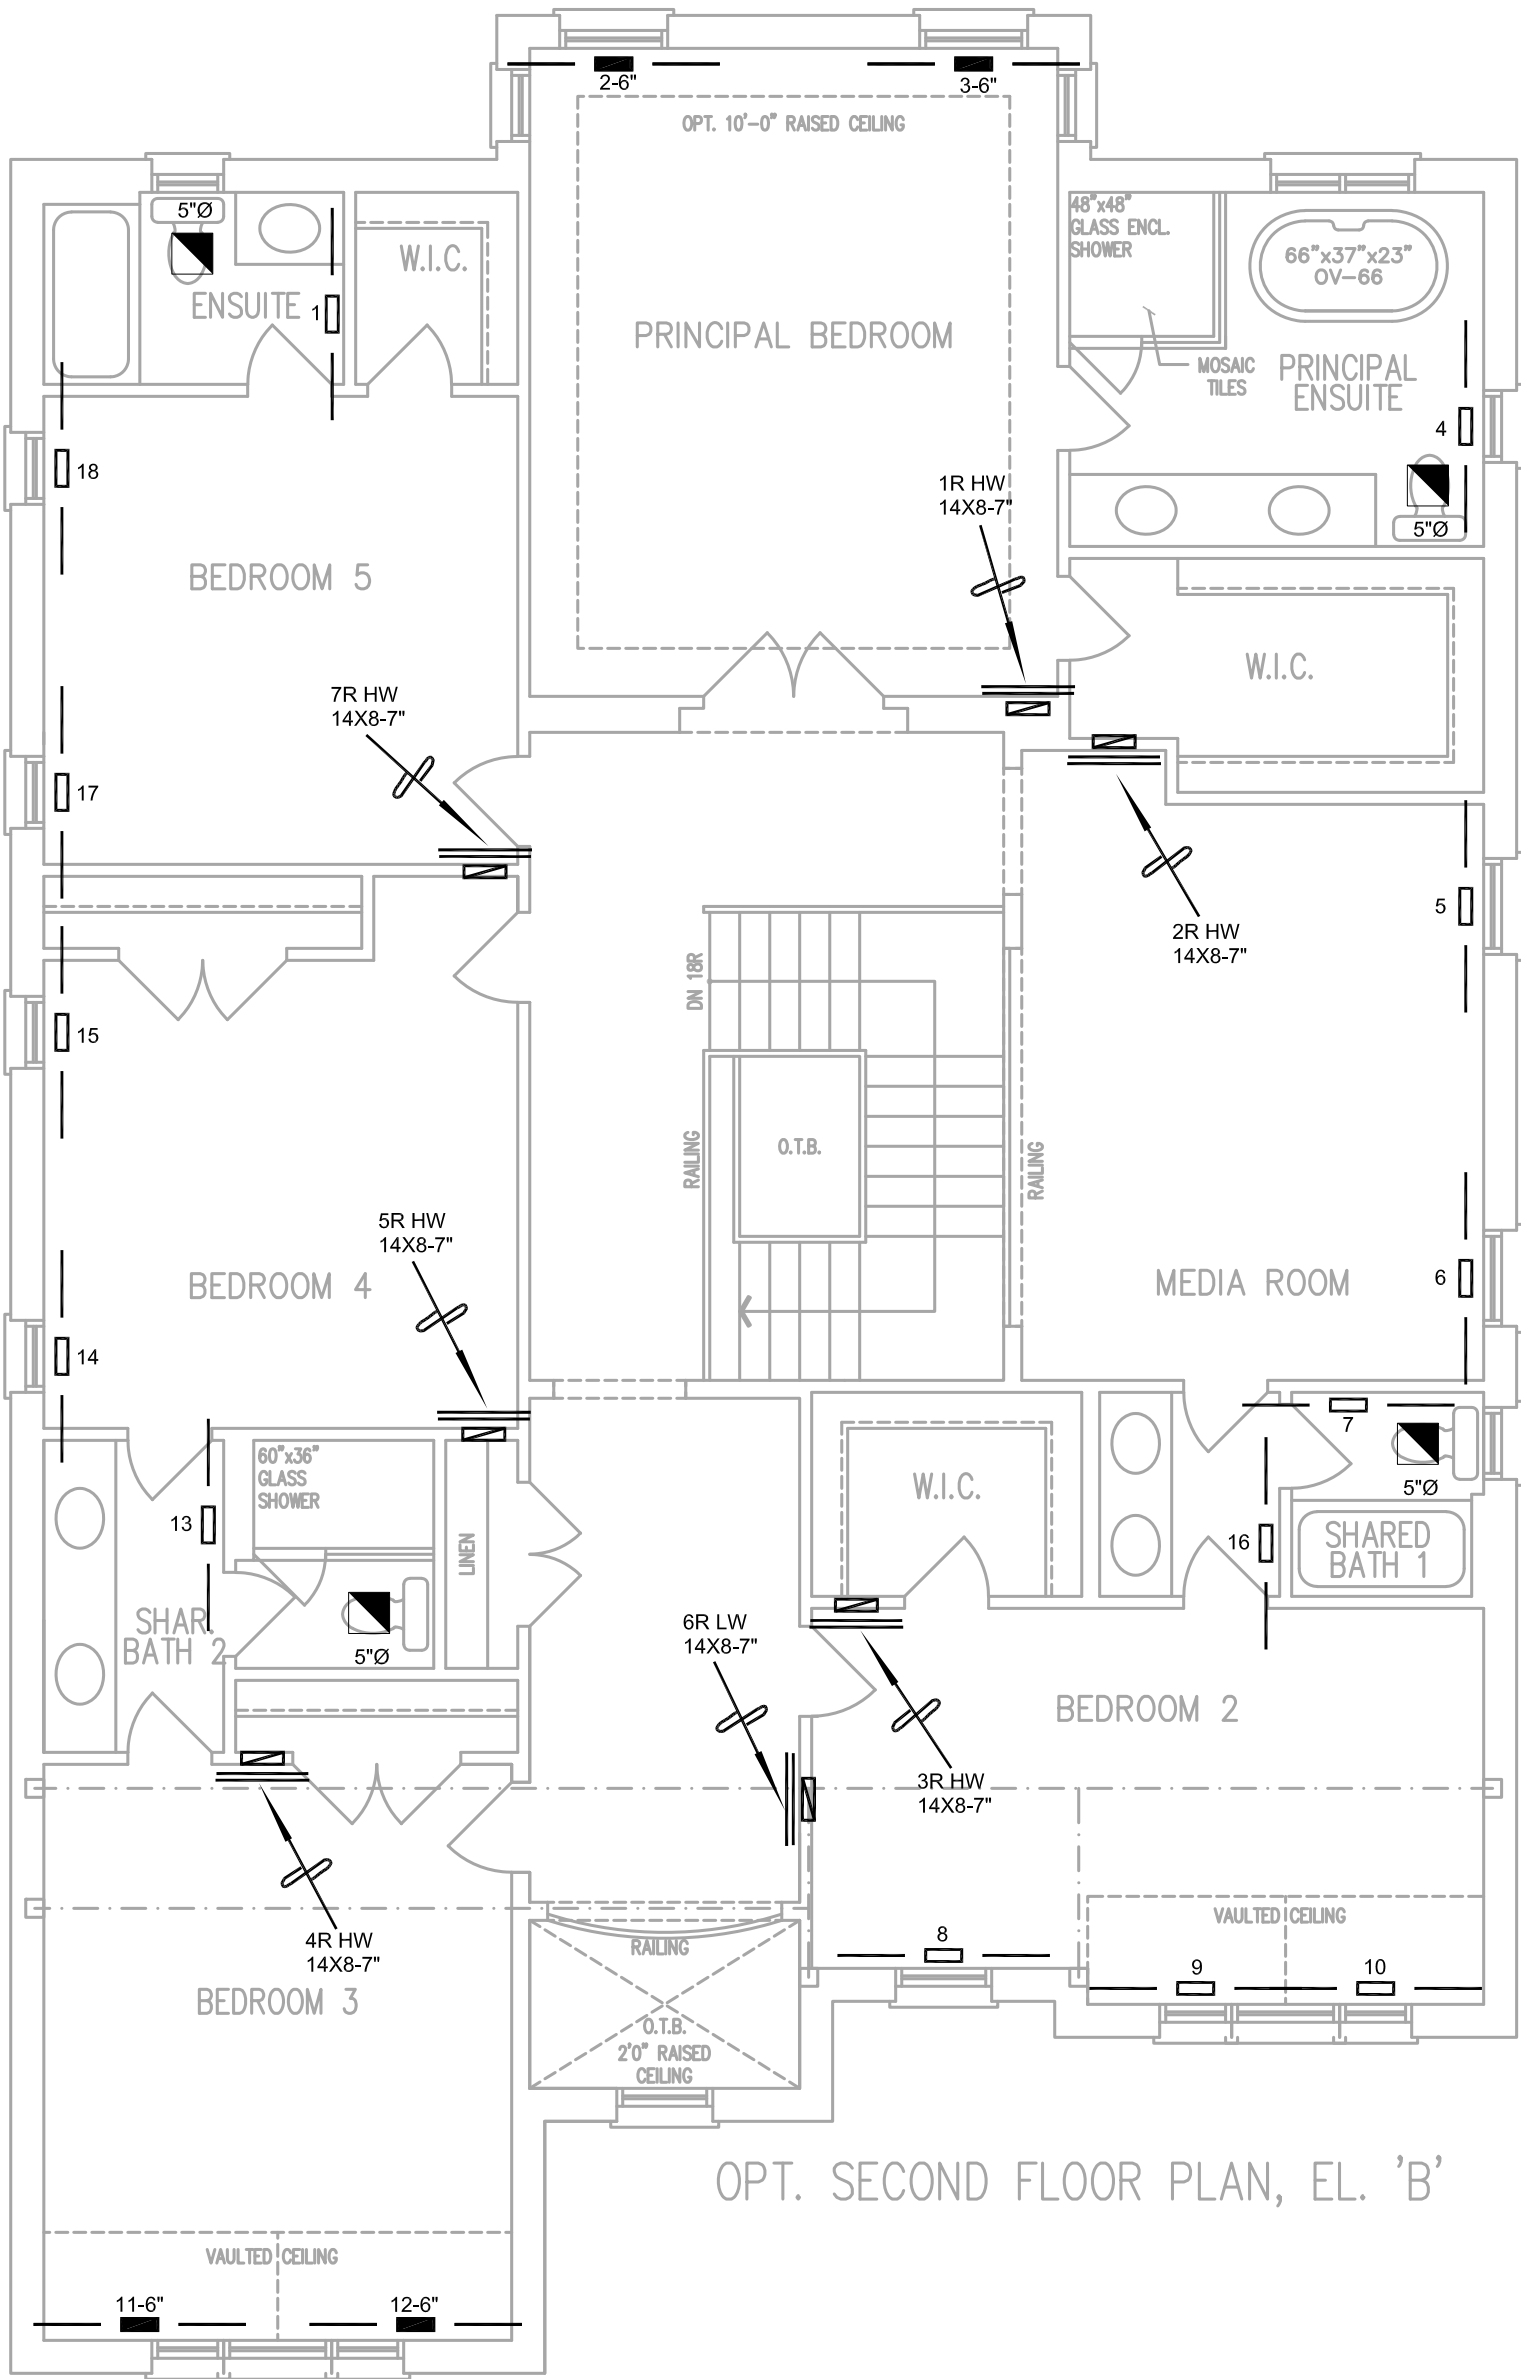

OPT. SECOND FLOOR PLAN, EL. 'B'

HVAC LEGEND								3.			
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.	REVISED EQUIPMENT		JULY/24
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.	REVISED TO PERFORMANCE PATH		APR/2022
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description		Date
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	REVISIONS			
ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.						I Michael O'Rourke have reviewed and take responsibility for the design work and am qualified under division C.3.2.5 of the building code.		 Michael O'Rourke BCIN # 19669 HVAC Designs Ltd.		SB-12 PERFORMANCE	
Client ROYAL PINE HOMES		 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdsgns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.				Michael O'Rourke have reviewed and take responsibility for the design work and am qualified under division C.3.2.5 of the building code. Michael O'Rourke BCIN # 19669 HVAC Designs Ltd.				Sheet Title SECOND FLOOR HEATING LAYOUT	
Project Name VALES OF HUMBER SOUTH BRAMPTON, ONTARIO										Date MAR/2022	
OPT IN-LAW - 2ND 5008 - ELEV B 4398 sqft										Scale 3/16" = 1'-0"	
										BCIN# 19669	
						LO#		95292			