


FRONT ELEVATION - PORCH END UNIT

A.la | SCALE: 3/16" = 1'-0"

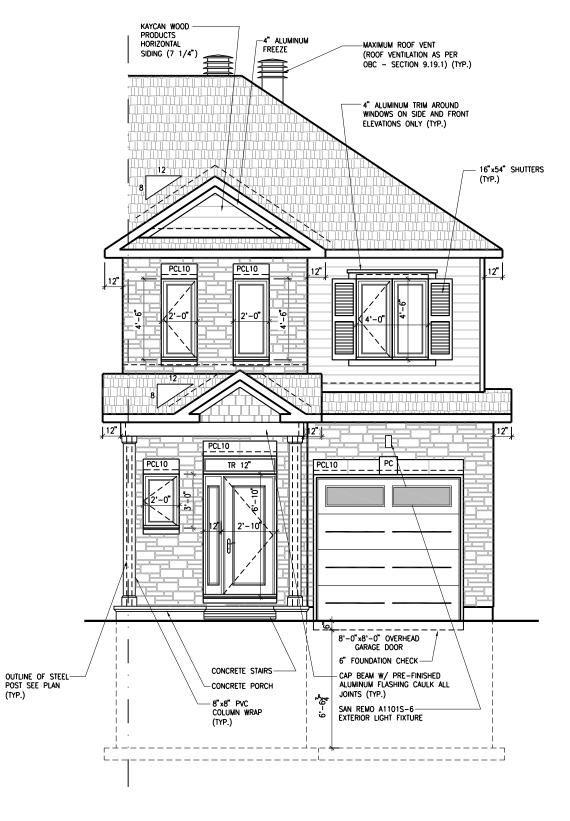

2 FRONT ELEVATION - GARAGE END UNIT

A.la | SCALE: 3/16" = 1'-0"

LOT: XXXX
DATE: XX/XX/XXXX

Valecraft
Homes (2019) Limited

I, <u>Daniel Guerin</u>, architectural manager for valecraft homes Ltd., have reviewed the following documents and take responsibility for the design activities.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCIMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER
DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING
CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

PC - PRECAST KEYSTONE
PCL10 - 10" PRECAST LINTEL

2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY


DRAWING:

(STANDARD DRAWINGS)

FRONT ELEVATION - END UNITS

ADDRESS: | SCALE: | DATE: | XX | 3/16" = 1'-0" | XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT A.1a

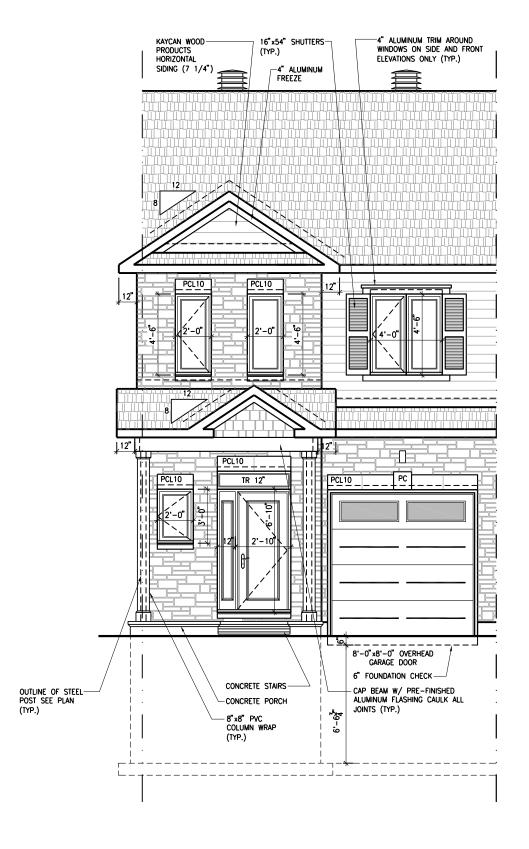



LOT: XXXX DATE: XX/XX/XXXX

Homes (2019) Limited

I<u>DANIEL GUERIN</u> ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

•• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM ••

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT, SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

PC - PRECAST KEYSTONE PCL10 - 10" PRECAST LINTEL

## 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY


FRONT ELEVATION - MID UNIT

| SCALE: | 3/16" = 1'-0" xx/xx/xxxx SHEET:

120 - THE HUNTLEY 2020 FOOTPRINT

(STANDARD DRAWINGS)

A.1b

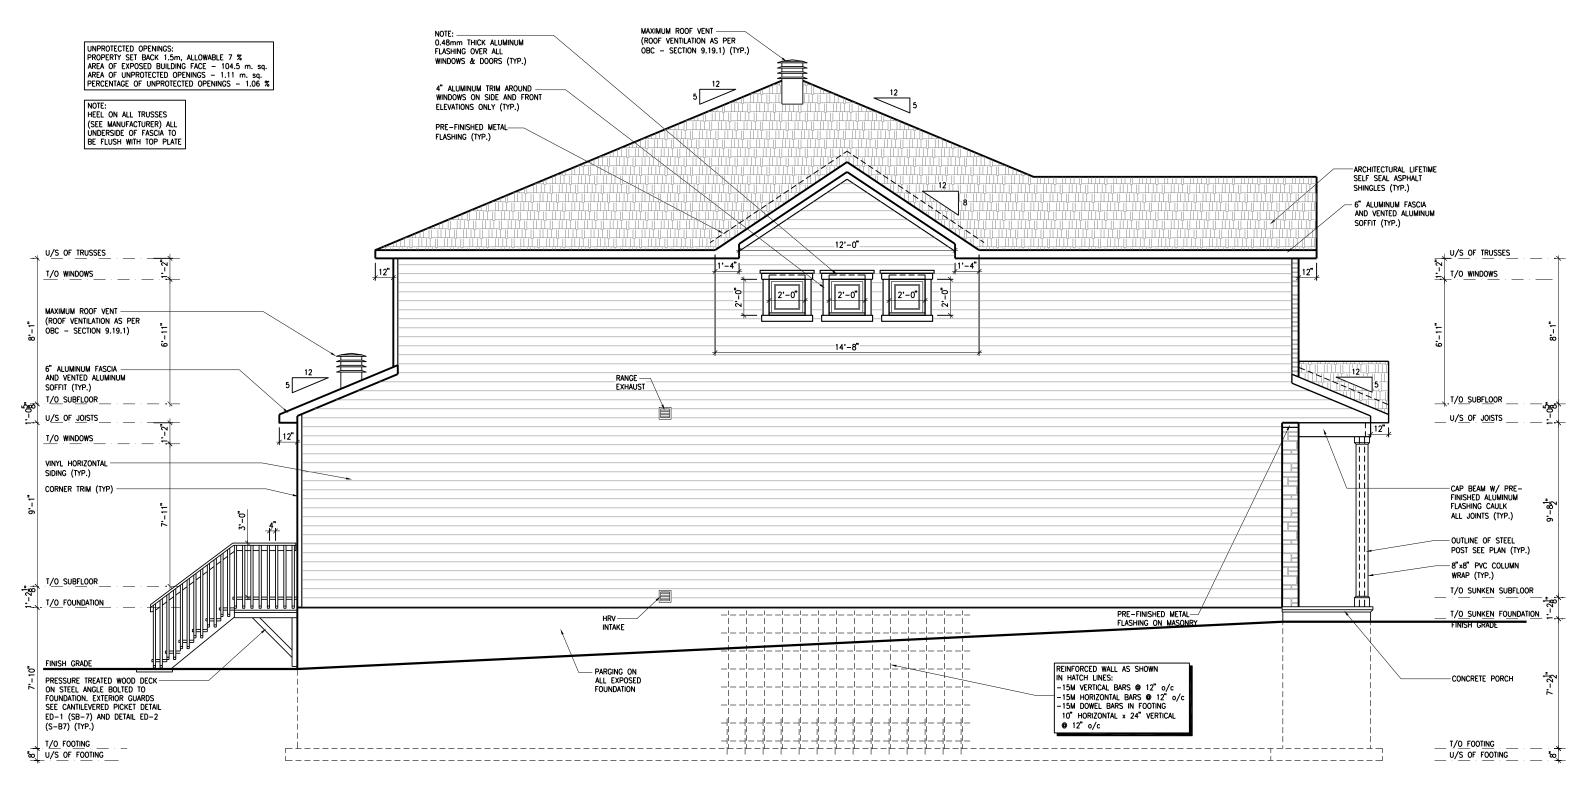



## **LEFT ELEVATION - PORCH END UNIT**

SCALE: 3/16" = 1'-0"

LOT: **XXXX** DATE: XX/XX/XXXX

Homes (2019) Limited

A - ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

B - THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

C - NO DIMENSION SHOULD BE SCALED ON DRAWINGS.
D - THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE. PERSONAL BCIN #19896

SITE.

- THIS DRAWING IS TO BE USED IN CONJUNCTION WITH
SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF
THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS
NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER
ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING
DOCUMENT.

I<u>, Daniel Guerin</u>, architectural manager for Valegraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities. TARION REGISTRATION NUMBER #611 \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*\* EV-4 NEW STANDARD DRWG MODIFICATION REV-3 AS PER STRUCTURAL REVIEW 03/20/2019 VH REV-2 AS PER STRUCTURAL REVIEW 11/07/2018 VH REV-1 NEW STANDARD DRWG MODIFICATION 11/13/2017 MAD


O DESCRIPTION MM/DD/YYYY BY


2012 O.B.C. DRAWINGS **LEFT ELEVATION PORCH END UNIT** ADDRESS: SCALE: 3/16" = 1'-0" XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT

(STANDARD DRAWINGS)

A.2a

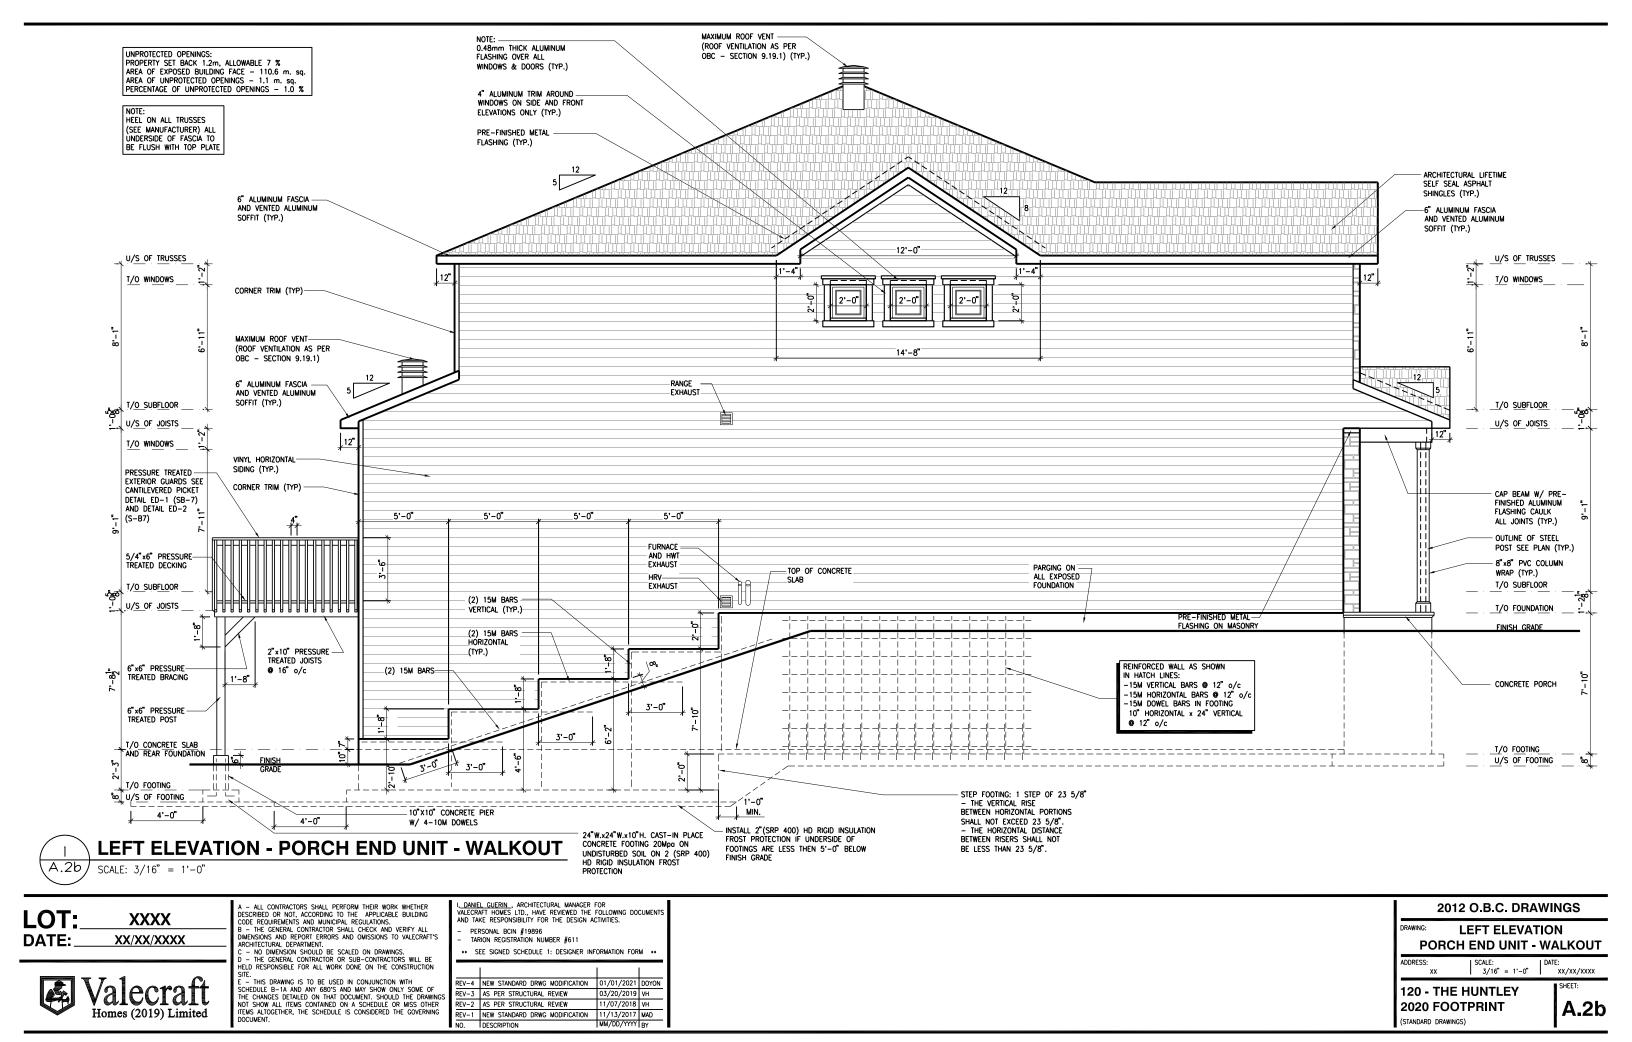

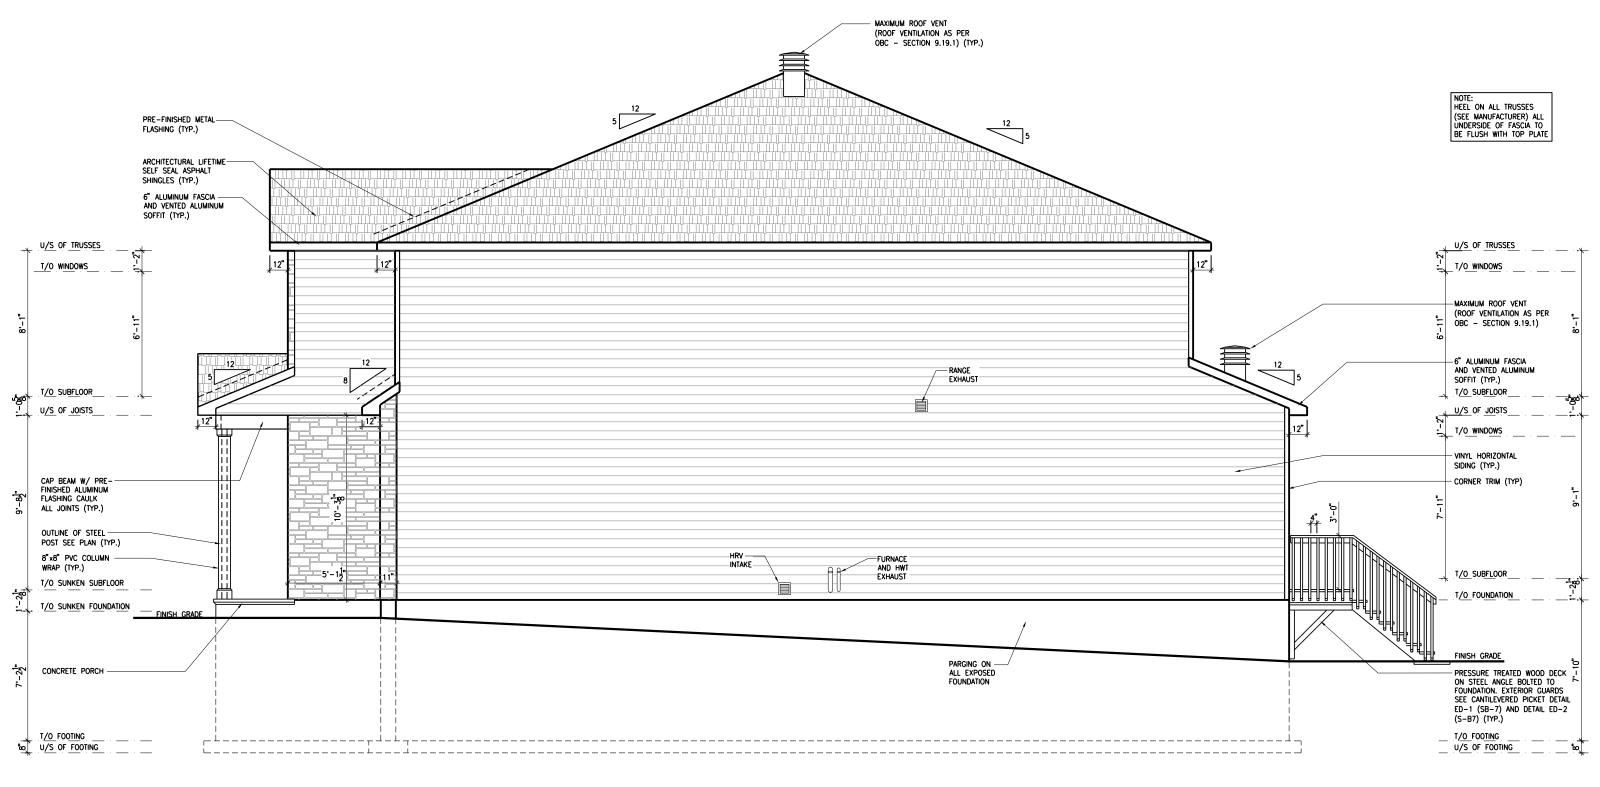



# **RIGHT ELEVATION - GARAGE END UNIT**

SCALE: 3/16" = 1'-0"

LOT: XXXX XX/XX/XXXX Valecratt Homes (2019) Limited A - ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT. ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

B - THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

C - NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

D - THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION STIE.

SITE.
E - THIS DRAWING IS TO BE USED IN CONJUNCTION WITH
SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF
THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS
NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER
ITEMS ALTOCETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING
DOCUMENT.

	VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.						
		RSONAL BCIN #19896 RION REGISTRATION NUMBER #611					
I	** SI	EE SIGNED SCHEDULE 1: DESIGNER INF	ORMATION FOR	M ••			
ı			I				
	REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON			
	REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH			
	REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH			
	REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD			
	NO.	DESCRIPTION	MM/DD/YYYY	BY			


I, DANIEL GUERIN, ARCHITECTURAL MANAGER FOR


2012 O.B.C. DRAWINGS RIGHT ELEVATION

**GARAGE END UNIT** ADDRESS: SCALE: 3/16" = 1'-0" XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT (STANDARD DRAWINGS)

A.2c

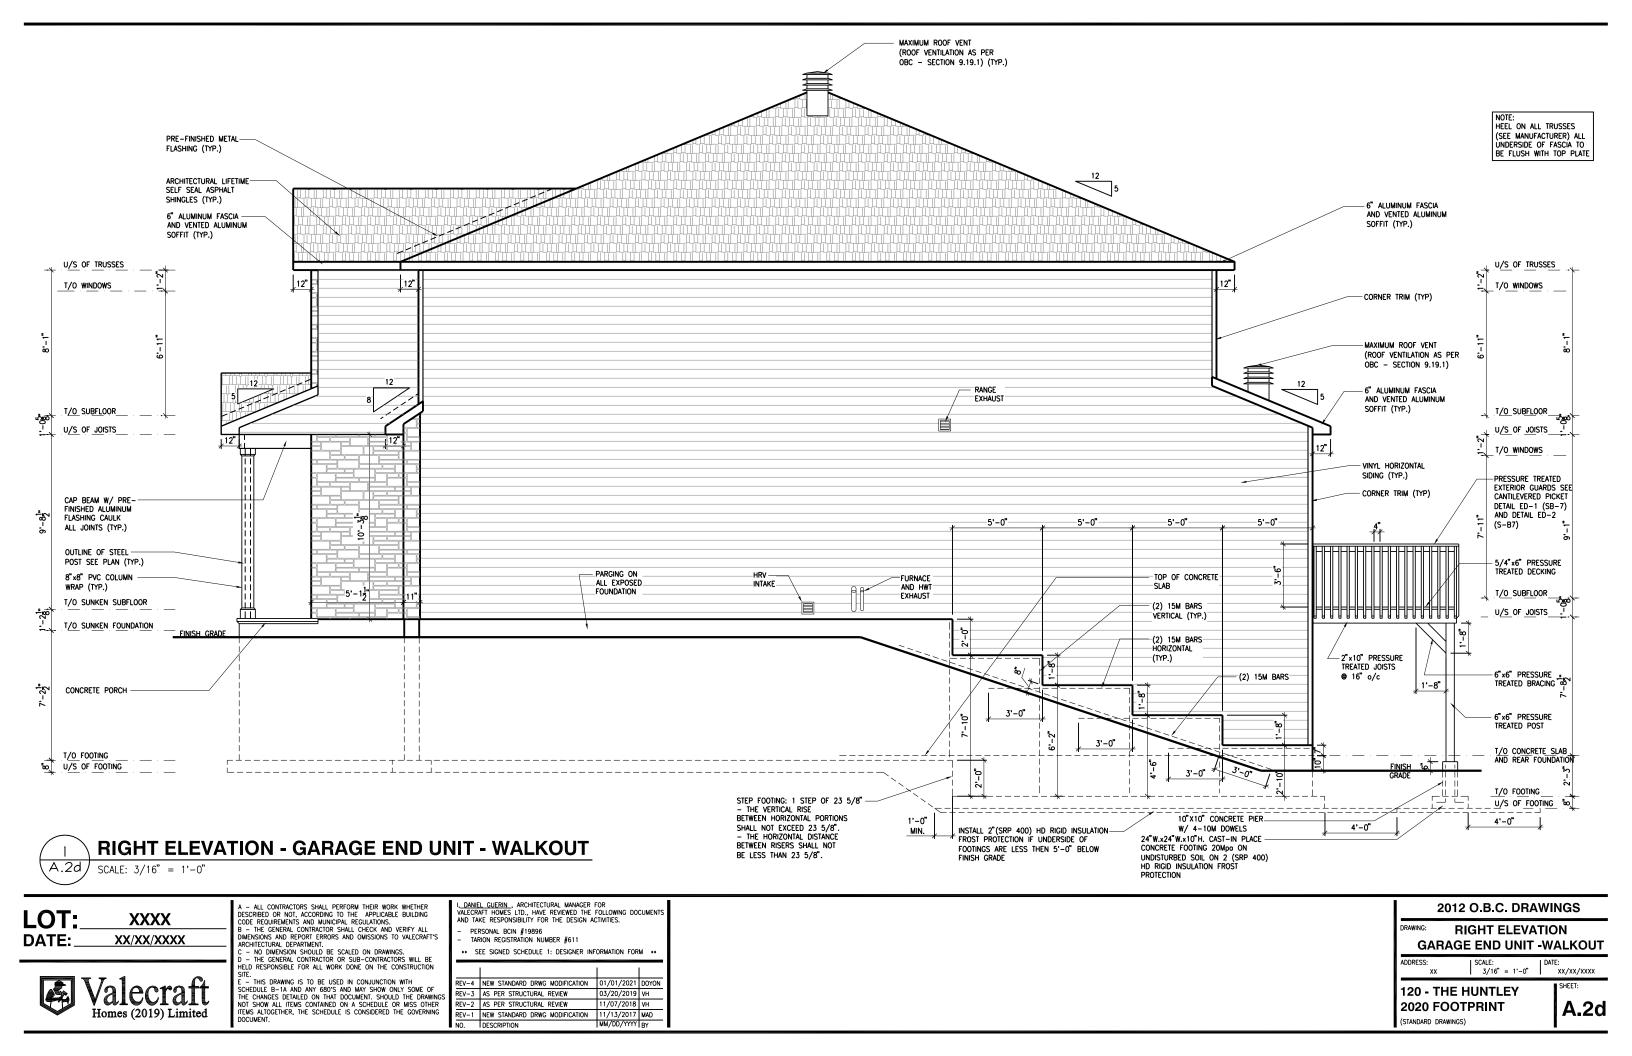


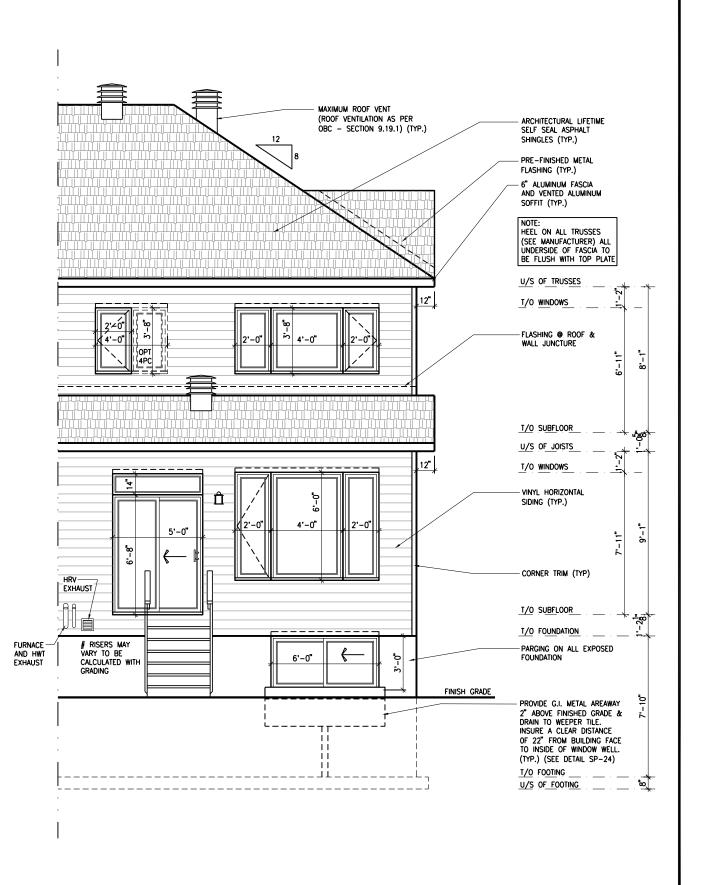

**REAR ELEVATION - PORCH END UNIT** 

2 REAR ELEVATION - PORCH END UNIT - WALKOUT

A.2e SCALE: 3/16" = 1'-0"

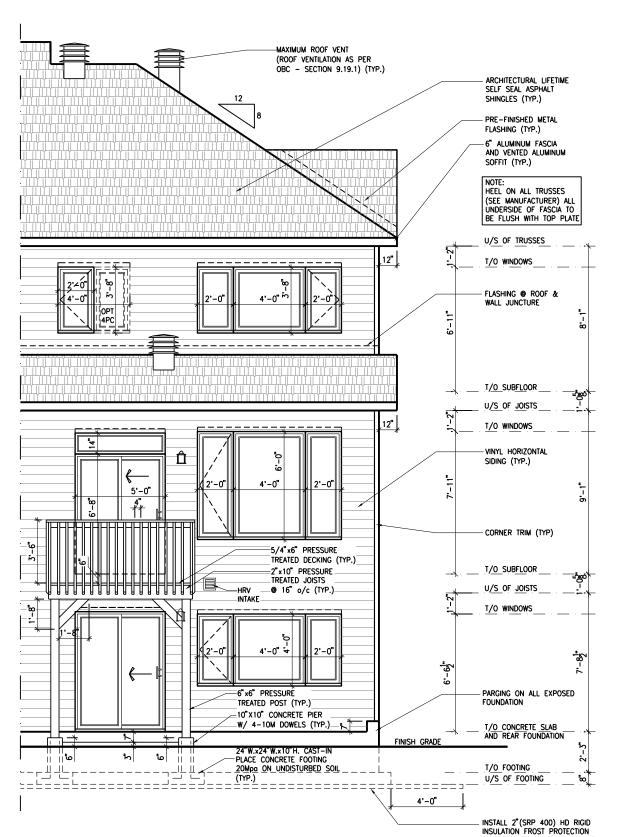

LOT: XXXX
DATE: XX/XX/XXXX

Valecraft
Homes (2019) Limited

I, <u>Daniel Guerin</u>, architectural manager for valecraft homes Ltd., have reviewed the following documents and take responsibility for the design activities.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

•• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE
B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE:
DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW
ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS
ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING
DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

PC - PRECAST KEYSTONE
PCL10 - 10" PRECAST LINTEL

2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

AWING: REAR ELEVATION

PORCH END UNITS

7 - THE HIINTI EV

120 - THE HUNTLEY 2020 FOOTPRINT

(STANDARD DRAWINGS)

IF UNDERSIDE OF FOOTINGS ARE

LESS THEN 5'-0" BELOW FINISH

A.2e


xx/xx/xxxx

SHEET





**REAR ELEVATION - GARAGE END UNIT** 

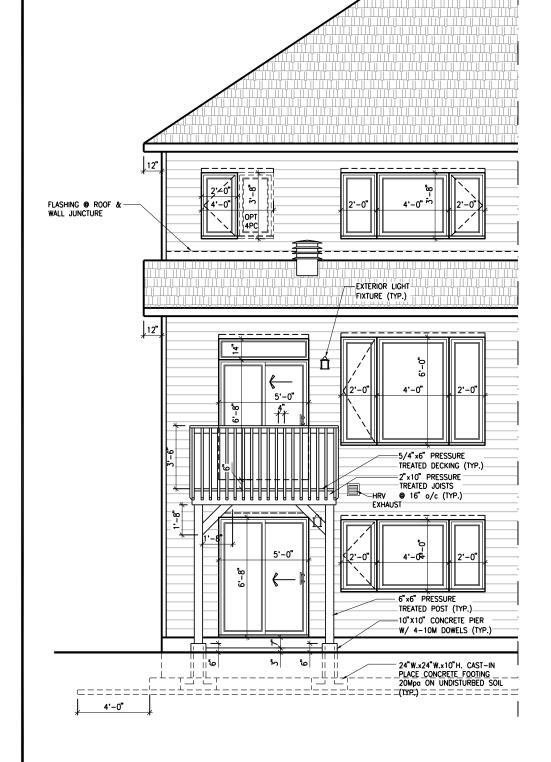

**REAR ELEVATION - GARAGE END UNIT - WALKOUT** 

SCALE: 3/16" = 1'-0"

MAXIMUM ROOF VENT -(ROOF VENTILATION AS PER OBC - SECTION 9.19.1) (TYP.) LOT: XXXX DATE: XX/XX/XXXX



I, <u>Daniel Guerin</u>, architectural manager for valecraft homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611
- •• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

PC - PRECAST KEYSTONE PCL10 - 10" PRECAST LINTEL

2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

**REAR ELEVATION** 


**GARAGE END UNITS** 

SCALE: 3/16" = 1'-0"


120 - THE HUNTLEY 2020 FOOTPRINT

A.2f

xx/xx/xxxx

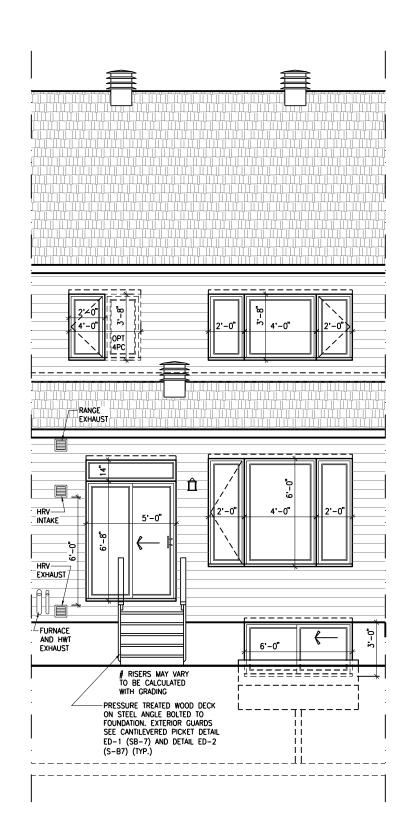



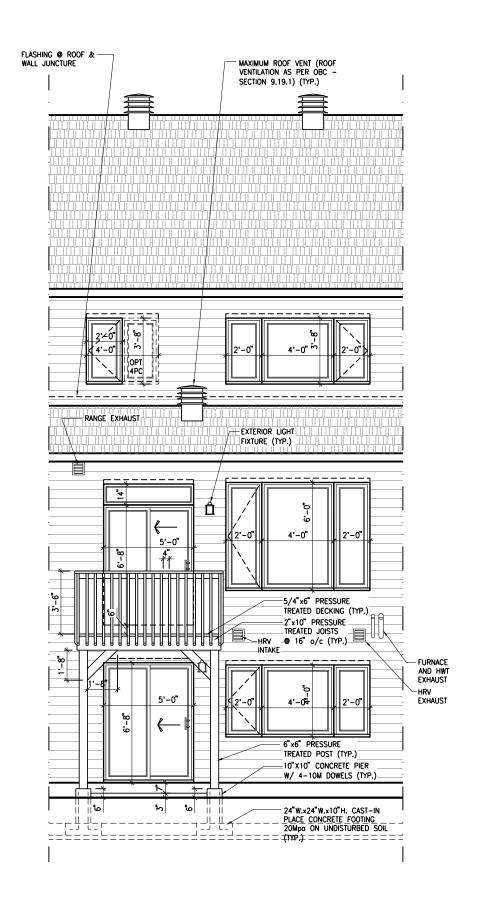

REAR ELEVATION - MID UNIT - WALKOUT

A.29 SCALE: 3/16" = 1'-0"

LOT: XXXX
DATE: XX/XX/XXXX

Valecraft
Homes (2019) Limited

I. DANIEL GUERIN. ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

PC - PRECAST KEYSTONE
PCL10 - 10" PRECAST LINTEL

2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VΗ
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY


DRAWING:

REAR ELEVATION - MID UNITS

ADDRESS: | SCALE: | DATE: | XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT

A.2g

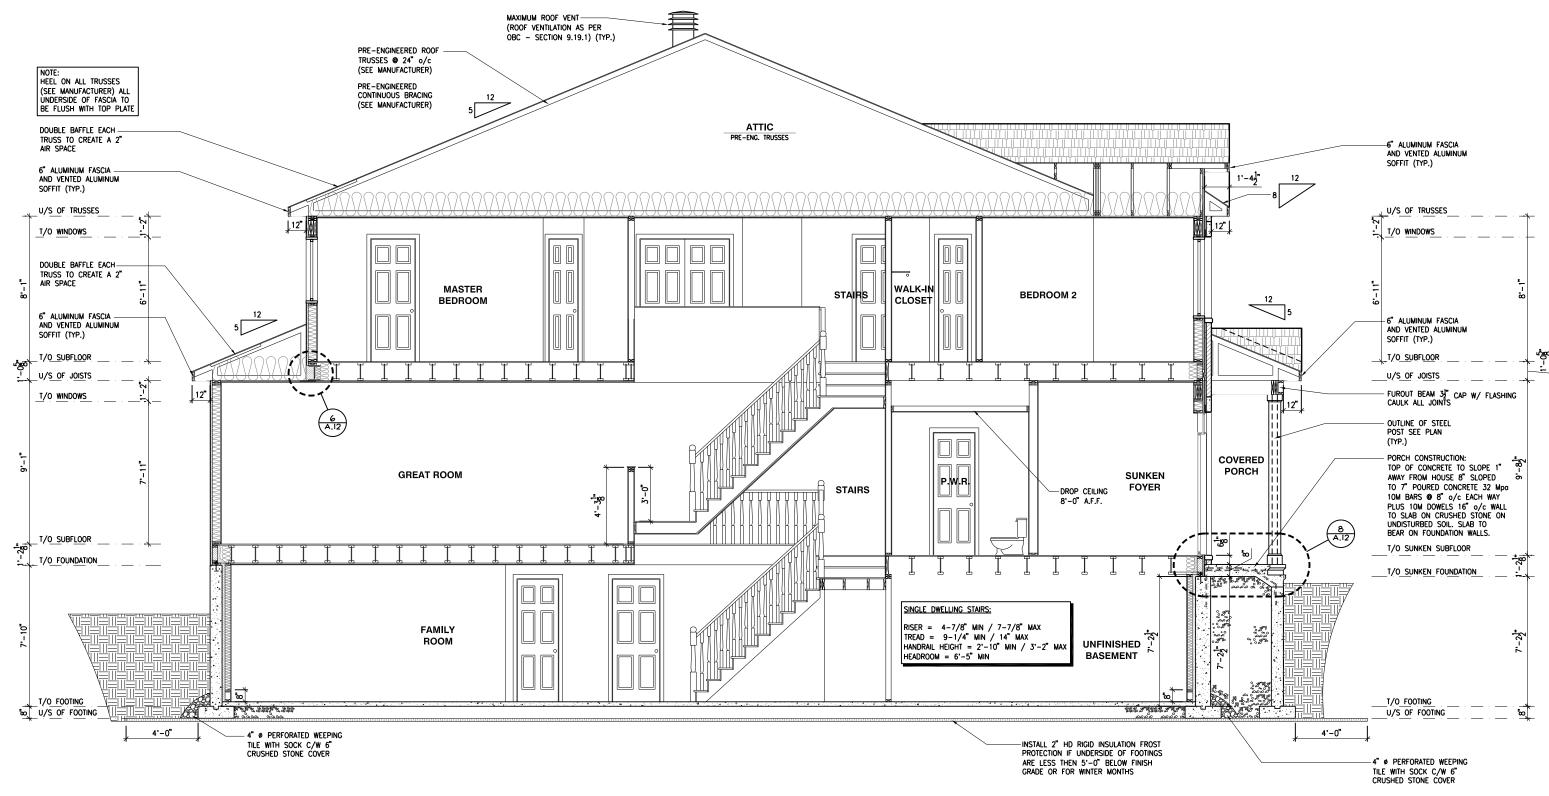



# **BUILDING SECTION**

SCALE: 3/16" = 1'-0"

LOT: **XXXX** DATE: XX/XX/XXXX



A - ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

B - THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

C - NO DIMENSION SHOULD BE SCALED ON DRAWINGS.
D - THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

SITE.

- THIS DRAWING IS TO BE USED IN CONJUNCTION WITH
SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF
THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS
NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER
ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING
DOCUMENT.

I<u>, Daniel Guerin</u>, architectural manager for Valegraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

PERSONAL BCIN #19896
TARION REGISTRATION NUMBER #611

\*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*\*

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO	DESCRIPTION	MM/DD/YYYY	RY


2012 O.B.C. DRAWINGS

**BUILDING SECTION** 

ADDRESS: SCALE: 3/16" = 1'-0" XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT (STANDARD DRAWINGS)


A.3a

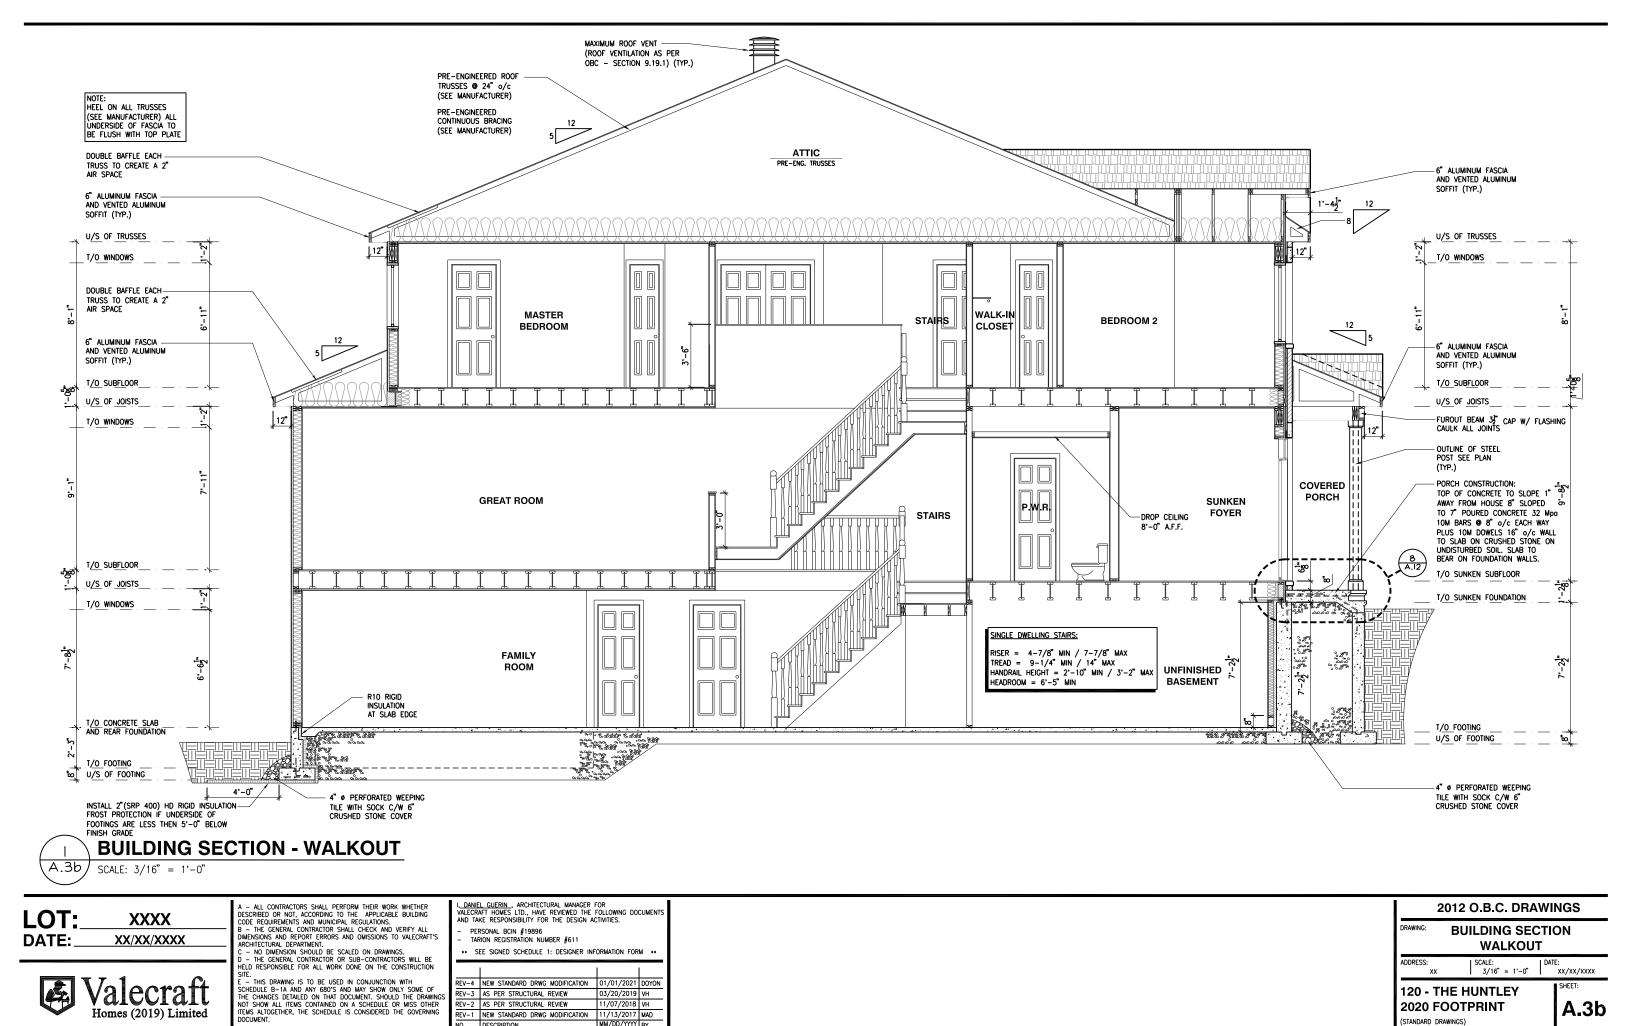


DESCRIPTION


MM/DD/YYYY BY


	F	OOTING SCHEDUL	E	
	ALLOWABLE SOIL BEARING CAR	PACITY / BEARING RESISTANCE	E AT SLS FOR «SITE CLASS:D»	)
WALL FOOTINGS	WALL FOOTINGS         100KPa         85KPa         75KPa         60KPa			
WF1	30"W. x 8"H. 2-15M LONGITUDINAL BARS	BARS 32" LONG @ 20" o/c	40"W. x 8"H. 15M TRANSVERSE BOTTOM BARS 36" LONG @ 20" o/c 3-15M LONGITUDINAL BARS	
WF2	28"W. x 8"H. 2-15M LONGITUDINAL BARS	34"W. x 8"H. 2-15M LONGITUDINAL BARS	38"W. x 8"H. 15M TRANSVERSE BOTTOM BARS 34" LONG @ 20" o/c 3-15M LONGITUDINAL BARS	
WF3	26"W. x 8"H. 2-15M LONGITUDINAL BARS	30"W. x 8"H. 2-15M LONGITUDINAL BARS	34"W. x 8"H. 2-15M LONGITUDINAL BARS	42"W. x 8"H. 15M TRANSVERSE BOTTOM BARS 38" LONG @ 20" o/c 3-15M LONGITUDINAL BARS
WF4	24"W. x 8"H. 2-15M LONGITUDINAL BARS	28"W. x 8"H. 2-15M LONGITUDINAL BARS	32"W. x 8"H. 2-15M LONGITUDINAL BARS	38"x8" DP. 15M TRANSVERSE BOTTOM BARS 34" LONG @ 20" o/c 3-15M LONGITUDINAL BARS
WF5	24"W. x 8"H. 2-15M LONGITUDINAL BARS	24"W. x 8"H. 2-15M LONGITUDINAL BARS	26"W. x 8"H. 2-15M LONGITUDINAL BARS	34"x8" DP. 2-15M LONGITUDINAL BARS
WF6	24"W. x 8"H. 2-15M LONGITUDINAL BARS	24"W. x 8"H. 2-15M LONGITUDINAL BARS	24"W. x 8"H. 2-15M LONGITUDINAL BARS	30"x8" DP. 2-15M LONGITUDINAL BARS
WF7	20"W. x 8"H. 2-15M LONGITUDINAL BARS	20"W. x 8"H. 2-15M LONGITUDINAL BARS	20"W. x 8"H. 2-15M LONGITUDINAL BARS	24"x8" DP. 2-15M LONGITUDINAL BARS
	PAI	FOOTING SCHED	JLE	
	ALLOWABLE SOIL BEARING CAR	PACITY / BEARING RESISTANCE	E AT SLS FOR «SITE CLASS:D»	)
POST FOOTINGS	100KPa	85KPa	75KPa	60KPa
F1	36"W.x36"W.x10"H. 3-15M LONGITUDINAL BARS x 30" LONG EACH WAY	38"W.x38"W.x10"H. 3-15M LONGITUDINAL BARS x 32" LONG EACH WAY	40"W.x40"W.x10"H. 3-15M LONGITUDINAL BARS x 34" LONG EACH WAY	44"W.x44"W.x10"H. 3-15M LONGITUDINAL BARS x 38" LONG EACH WAY
F2	24"W. x 24"W. x 10"H.	24"W. x 24"W. x 10"H.	24"W. x 24"W. x 10"H.	28"W. x 28"W. x 12"H.

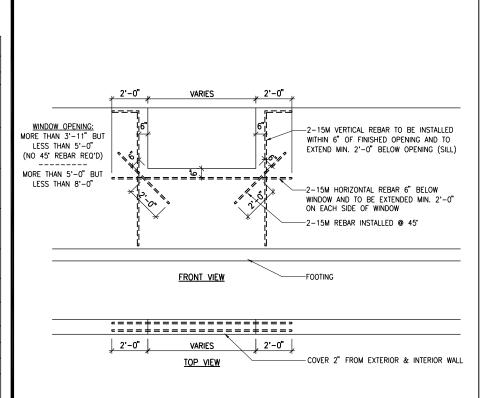

**BASEMENT WINDOW REINFORCING** 

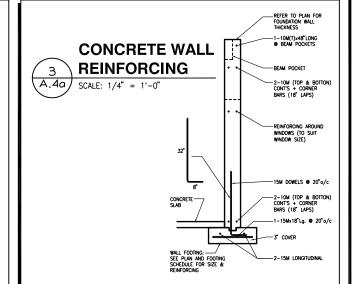

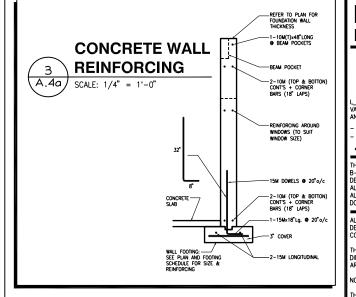

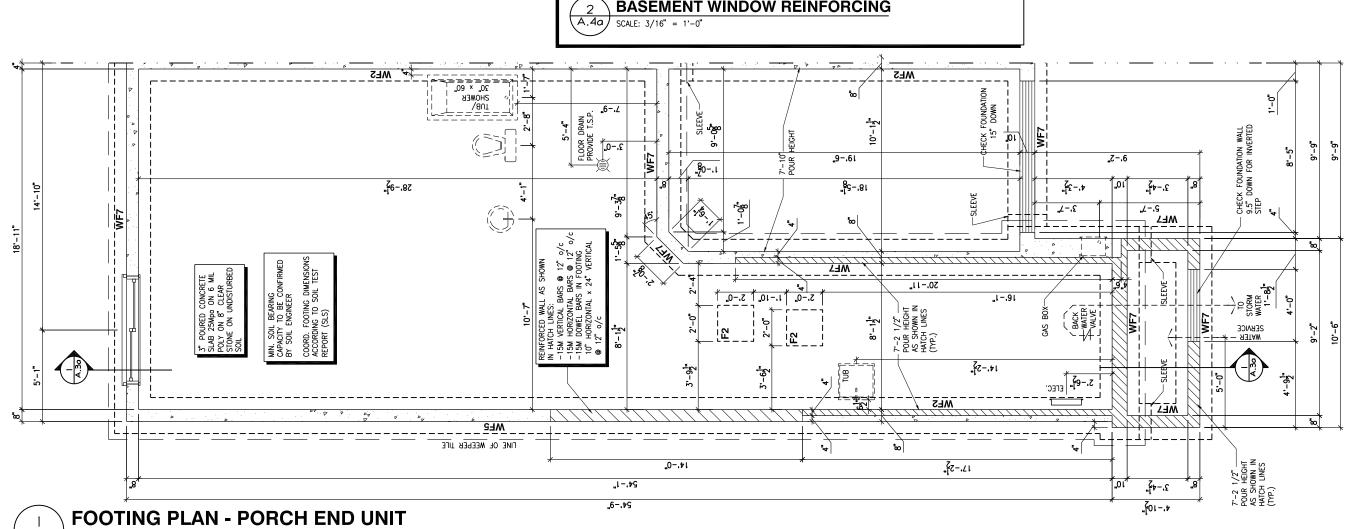

LOT: **XXXX** DATE: XX/XX/XXXX

Homes (2019) Limited

DANIEL GUERIN., ARCHITECTURAL MANAGER FOR
MALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS
UND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BCIN #19896
- TARION REGISTRATION NUMBER #611

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOCETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER
DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING
CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

- Footings have been designed for the allowable soil bearing capacity or bearing resistance at SLS and design parameters outlined in a geotechnical report REPORT PREPARED BY PATERSON GROUP AND/OR OTHERS (AVAILABLE UPON REQUEST);
- BEARING STRATA TO BE INSPECTED AND THE BEARING VALUE AND UNDER SIDE OF FOOTING (USF) ELEVATION CONFIRMED BY GEOTECHNICAL CONSULTANT AT TIME OF EXCAVATION;
- THICKNESS OF L.W.F. IS SPECIFIED ON DRAWINGS.
  THICKNESS OF L.W.F. AT GARAGES, PORCHES AND PLACEMENT
  OF L.W.F. AT OTHER AREAS, IF REQUIRED, TO BE CONFIRMED
  AS PER GEOTECHNICAL CONSULTANTS RECOMMENDATIONS AT THE TIME OF EXCAVATION:
- FOR ALLOWABLE BEARING VALUES OUTSIDE OF THE FOOTING SCHEDULE, CONTACT THE STRUCTURAL ENGINEER FOR INSTRUCTIONS;
- CONCRETE STRENGTH @ 28 DAYS FOR FOOTINGS AND WALL = 20MPo AND CONCRETE FOR FOUNDATION WALLS SHOULD HAVE 6% ( $\pm$  1%) AIR ENTRAINMENT;
- REINFORCING STEEL SHALL COMPLY TO G30.18 GRADE 400;
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE ARCHITECTURAL FOUNDATION PLAN FOR THE SPECIFIC MODEL AND ARCHITECTURAL SPECIFICATION.

## 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

FOOTING PLAN -PORCH END UNIT

3/16" = 1'-0" XX/XX/XXXX


120 - THE HUNTLEY 2020 FOOTPRINT


SHEET A.4a


SCALE: 3/16" = 1'-0"

(A.4a)

	FOOTING SCHEDULE				
	ALLOWABLE SOIL BEARING CAF		<del></del>	»	
WALL FOOTINGS	100KPa	85KPa	75KPa	60KPa	
WF1	30"W. x 8"H. 2-15M LONGITUDINAL BARS	36"W. x 8"H. 15M TRANSVERSE BOTTOM BARS 32" LONG @ 20" o/c 3-15M LONGITUDINAL BARS	40"W. x 8"H. 15M TRANSVERSE BOTTOM BARS 36" LONG @ 20" o/c 3-15M LONGITUDINAL BARS	48"W. x 8"H. 15M TRANSVERSE BOTTOM BARS 42" LONG @ 16" o/c 3-15M LONGITUDINAL BARS	
WF2	28"W. x 8"H. 2-15M LONGITUDINAL BARS	34"W. x 8"H. 2-15M LONGITUDINAL BARS	38"W. x 8"H. 15M TRANSVERSE BOTTOM BARS 34" LONG @ 20" o/c 3-15M LONGITUDINAL BARS	3-15M LONGITUDINAL BAŔS	
WF3	26"W. x 8"H. 2-15M LONGITUDINAL BARS	30"W. × 8"H. 2-15M LONGITUDINAL BARS	34"W. x 8"H. 2-15M LONGITUDINAL BARS	3-15M LONGITUDINAL BARS	
WF4	24"W. x 8"H. 2-15M LONGITUDINAL BARS	28"W. x 8"H. 2-15M LONGITUDINAL BARS	32"W. x 8"H. 2-15M LONGITUDINAL BARS	38"x8" DP. 15M TRANSVERSE BOTTOM BARS 34" LONG @ 20" o/c 3-15M LONGITUDINAL BARS	
WF5	24"W. x 8"H. 2-15M LONGITUDINAL BARS	24"W. x 8"H. 2-15M LONGITUDINAL BARS	26"W. x 8"H. 2-15M LONGITUDINAL BARS	34"x8" DP. 2-15M LONGITUDINAL BARS	
WF6	24"W. x 8"H. 2-15M LONGITUDINAL BARS	24"W. x 8"H. 2-15M LONGITUDINAL BARS	24"W. x 8"H. 2-15M LONGITUDINAL BARS	30"x8" DP. 2-15M LONGITUDINAL BARS	
WF7	20"W. x 8"H. 2-15M LONGITUDINAL BARS	20"W. x 8"H. 2-15M LONGITUDINAL BARS	20"W. x 8"H. 2-15M LONGITUDINAL BARS	24"x8" DP. 2-15M LONGITUDINAL BARS	
	PA	D FOOTING SCHEDU	JLE		
	ALLOWABLE SOIL BEARING CAP	PACITY / BEARING RESISTANCE	AT SLS FOR «SITE CLASS:D»	)	
POST FOOTINGS	100KPa	85KPa	75KPa	60KPa	
F1	36"W.x36"W.x10"H. 3-15M LONGITUDINAL BARS x 30" LONG EACH WAY	38"W.x38"W.x10"H. 3-15M LONGITUDINAL BARS x 32" LONG EACH WAY	40"W.x40"W.x10"H. 3-15M LONGITUDINAL BARS x 34" LONG EACH WAY	44"W.x44"W.x10"H. 3-15M LONGITUDINAL BARS x 38" LONG EACH WAY	
F2	24"W. x 24"W. x 10"H.	24"W. x 24"W. x 10"H.	24"W. x 24"W. x 10"H.	28"W. x 28"W. x 12"H.	

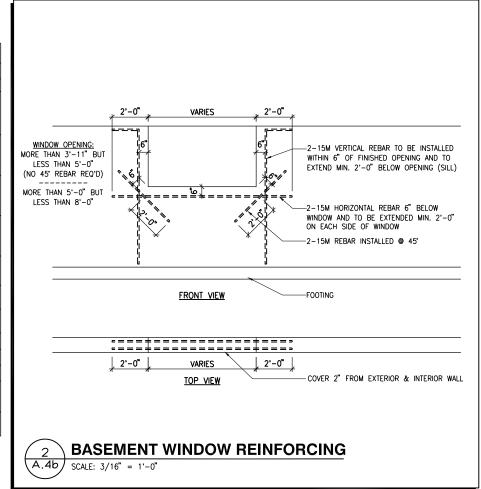

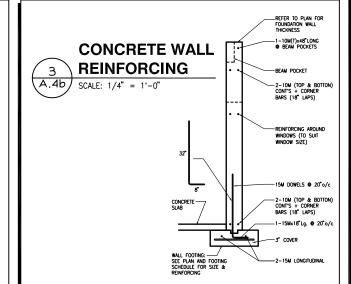

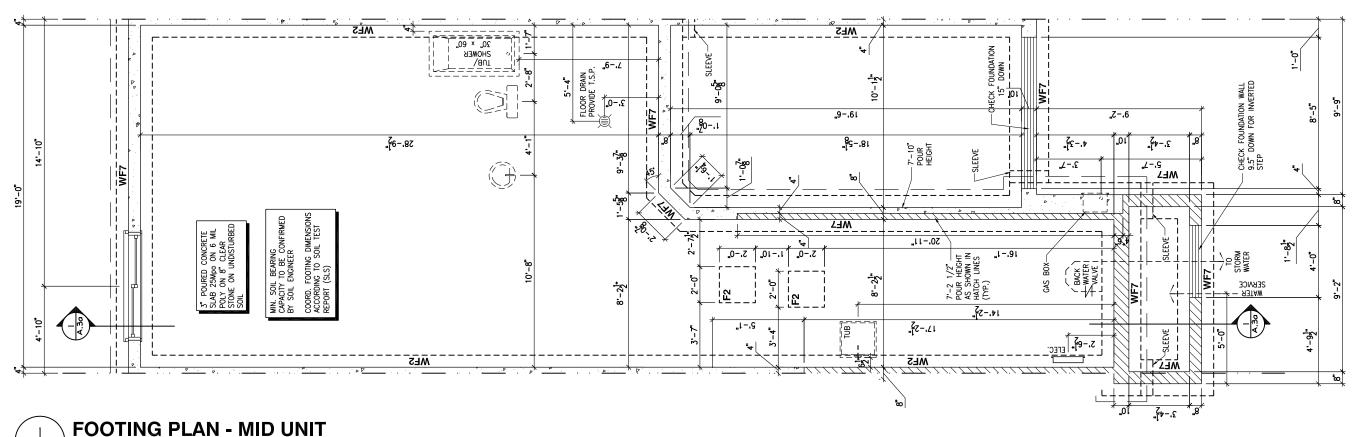

LOT: **XXXX** XX/XX/XXXX DATE:



DANIEL GUERIN., ARCHITECTURAL MANAGER FOR
MALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS
UND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BCIN #19896
- TARION REGISTRATION NUMBER #611

HIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE -- TA AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANCES ETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW LL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS LTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

- Footings have been designed for the allowable soil bearing capacity or bearing resistance at SLS and design parameters outlined in a geotechnical report REPORT PREPARED BY PATERSON GROUP AND/OR OTHERS (AVAILABLE UPON REQUEST);
- BEARING STRATA TO BE INSPECTED AND THE BEARING VALUE AND UNDER SIDE OF FOOTING (USF) ELEVATION CONFIRMED BY GEOTECHNICAL CONSULTANT AT TIME OF EXCAVATION;
- THICKNESS OF L.W.F. IS SPECIFIED ON DRAWINGS.
  THICKNESS OF L.W.F. AT GARAGES, PORCHES AND PLACEMENT
  OF L.W.F. AT OTHER AREAS, IF REQUIRED, TO BE CONFIRMED
  AS PER GEOTECHNICAL CONSULTANTS RECOMMENDATIONS AT THE TIME OF EXCAVATION:
- FOR ALLOWABLE BEARING VALUES OUTSIDE OF THE FOOTING SCHEDULE, CONTACT THE STRUCTURAL ENGINEER FOR INSTRUCTIONS;
- CONCRETE STRENGTH @ 28 DAYS FOR FOOTINGS AND WALL = 20MPo AND CONCRETE FOR FOUNDATION WALLS SHOULD HAVE 6% ( $\pm$  1%) AIR ENTRAINMENT;
- REINFORCING STEEL SHALL COMPLY TO G30.18 GRADE 400;
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE ARCHITECTURAL FOUNDATION PLAN FOR THE SPECIFIC MODEL AND ARCHITECTURAL SPECIFICATION.

2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

**FOOTING PLAN - MID UNIT** 


3/16" = 1'-0" XX/XX/XXXX


120 - THE HUNTLEY 2020 FOOTPRINT


SHEET A.4b


(A.4b)

	FOOTING SCHEDULE				
	ALLOWABLE SOIL BEARING CAP				
WALL FOOTINGS	100KPa	85KPa	75KPa	60KPa	
WF1	30"W. x 8"H. 2-15M LONGITUDINAL BARS	36"W. x 8"H. 15M TRANSVERSE BOTTOM BARS 32" LONG @ 20" o/c 3-15M LONGITUDINAL BARS	40"W. x 8"H. 15M TRANSVERSE BOTTOM BARS 36" LONG @ 20" o/c 3-15M LONGITUDINAL BARS	48"W. x 8"H. 15M TRANSVERSE BOTTOM BARS 42" LONG @ 16" o/c 3-15M LONGITUDINAL BARS	
WF2	28"W. x 8"H. 2-15M LONGITUDINAL BARS	34"W. x 8"H. 2-15M LONGITUDINAL BARS	38"W. x 8"H. 15M TRANSVERSE BOTTOM BARS 34" LONG @ 20" o/c 3-15M LONGITUDINAL BARS	46"W. x 8"H. 15M TRANSVERSE BOTTOM BARS 42" LONG @ 16" o/c 3-15M LONGITUDINAL BARS	
WF3	26"W. x 8"H. 2-15M LONGITUDINAL BARS	30"W. x 8"H. 2-15M LONGITUDINAL BARS	34"W. x 8"H. 2-15M LONGITUDINAL BARS	42"W. x 8"H. 15M TRANSVERSE BOTTOM BARS 38" LONG @ 20" o/c 3-15M LONGITUDINAL BARS	
WF4	24"W. x 8"H. 2-15M LONGITUDINAL BARS	28"W. x 8"H. 2-15M LONGITUDINAL BARS	32"W. x 8"H. 2-15M LONGITUDINAL BARS	38"x8" DP. 15M TRANSVERSE BOTTOM BARS 34" LONG @ 20" o/c 3-15M LONGITUDINAL BARS	
WF5	24"W. x 8"H. 2-15M LONGITUDINAL BARS	24"W. x 8"H. 2-15M LONGITUDINAL BARS	26"W. x 8"H. 2-15M LONGITUDINAL BARS	34"x8" DP. 2-15M LONGITUDINAL BARS	
WF6	24"W. x 8"H. 2-15M LONGITUDINAL BARS	24"W. x 8"H. 2-15M LONGITUDINAL BARS	24"W. x 8"H. 2-15M LONGITUDINAL BARS	30"x8" DP. 2-15M LONGITUDINAL BARS	
WF7	20"W. x 8"H. 2-15M LONGITUDINAL BARS	20"W. x 8"H. 2-15M LONGITUDINAL BARS	20"W. x 8"H. 2-15M LONGITUDINAL BARS	24"x8" DP. 2-15M LONGITUDINAL BARS	
	РАГ	D FOOTING SCHEDU	JLE		
	ALLOWABLE SOIL BEARING CAP	PACITY / BEARING RESISTANCE	E AT SLS FOR «SITE CLASS:D»	,	
POST FOOTINGS	100KPa	85KPa	75KPa	60KPa	
F1	36"W.x36"W.x10"H. 3-15M LONGITUDINAL BARS x 30" LONG EACH WAY	38"W.x38"W.x10"H. 3-15M LONGITUDINAL BARS x 32" LONG EACH WAY	40"W.x40"W.x10"H. 3-15M LONGITUDINAL BARS x 34" LONG EACH WAY	44"W.x44"W.x10"H. 3-15M LONGITUDINAL BARS x 38" LONG EACH WAY	
F2	24"W. x 24"W. x 10"H.	24"W. x 24"W. x 10"H.	24"W. x 24"W. x 10"H.	28"W. x 28"W. x 12"H.	

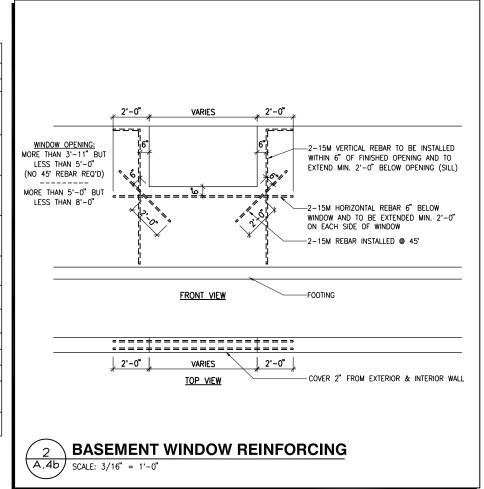

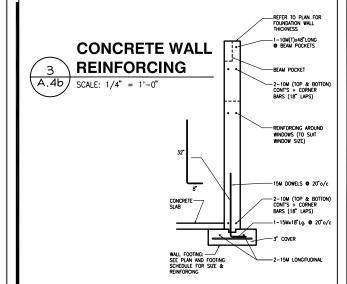

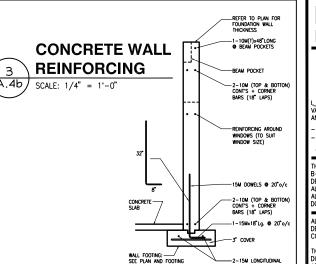



Homes (2019) Limited

DANIEL GUERIN., ARCHITECTURAL MANAGER FOR
MALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS
UND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BCIN #19896
- TARION REGISTRATION NUMBER #611

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINAED ON A SCHEDULE OR MISS OTHER TEMS ALTOCETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING


ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

- Footings have been designed for the allowable soil bearing capacity or bearing resistance at SLS and design parameters outlined in a geotechnical report REPORT PREPARED BY PATERSON GROUP AND/OR OTHERS (AVAILABLE UPON REQUEST);
- BEARING STRATA TO BE INSPECTED AND THE BEARING VALUE AND UNDER SIDE OF FOOTING (USF) ELEVATION CONFIRMED BY GEOTECHNICAL CONSULTANT AT TIME OF EXCAVATION;
- THICKNESS OF L.W.F. IS SPECIFIED ON DRAWINGS.
  THICKNESS OF L.W.F. AT GARAGES, PORCHES AND PLACEMENT
  OF L.W.F. AT OTHER AREAS, IF REQUIRED, TO BE CONFIRMED
  AS PER GEOTECHNICAL CONSULTANTS RECOMMENDATIONS AT THE TIME OF EXCAVATION:
- FOR ALLOWABLE BEARING VALUES OUTSIDE OF THE FOOTING SCHEDULE, CONTACT THE STRUCTURAL ENGINEER FOR INSTRUCTIONS;
- CONCRETE STRENGTH @ 28 DAYS FOR FOOTINGS AND WALL = 20MPo AND CONCRETE FOR FOUNDATION WALLS SHOULD HAVE 6% ( $\pm$  1%) AIR ENTRAINMENT;
- REINFORCING STEEL SHALL COMPLY TO G30.18 GRADE 400;
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE ARCHITECTURAL FOUNDATION PLAN FOR THE SPECIFIC MODEL AND ARCHITECTURAL SPECIFICATION.

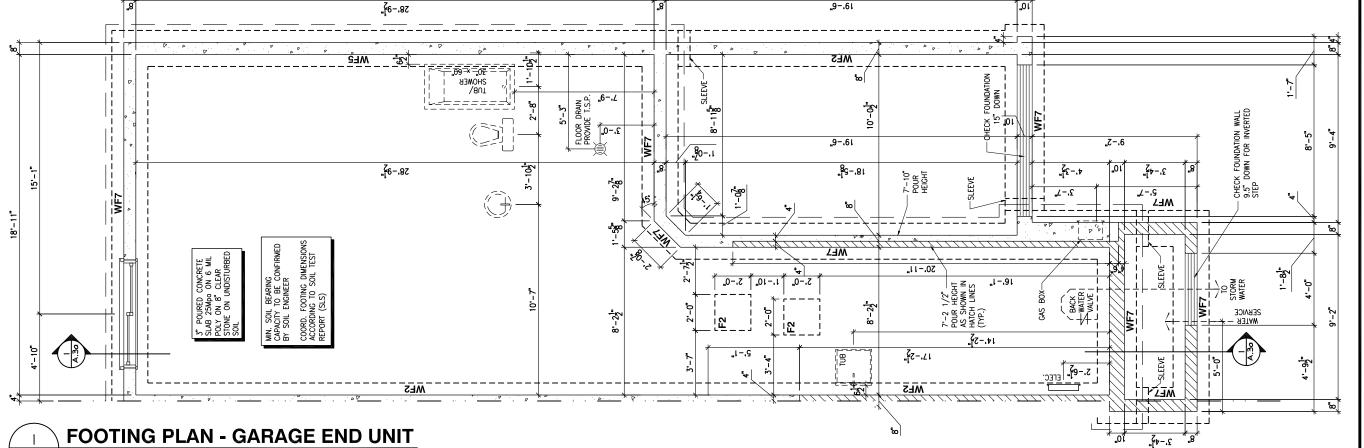

2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

**FOOTING PLAN - GARAGE END** 

3/16" = 1'-0" XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT


(STANDARD DRAWINGS)


A.4c


SHEET


( A.4c

	FOOTING SCHEDULE				
	ALLOWABLE SOIL BEARING CAR	PACITY / BEARING RESISTANCE	AT SLS FOR «SITE CLASS:D»	,	
WALL FOOTINGS	100KPa	85KPa	75KPa	60KPa	
WF1	30"W. x 8"H. 2-15M LONGITUDINAL BARS	36"W. x 8"H. 15M TRANSVERSE BOTTOM BARS 32" LONG @ 20" o/c 3-15M LONGITUDINAL BARS		48"W. x 8"H. 15M TRANSVERSE BOTTOM BARS 42" LONG @ 16" o/c 3-15M LONGITUDINAL BARS	
WF2	28"W. x 8"H. 2-15M LONGITUDINAL BARS	34"W. x 8"H. 2-15M LONGITUDINAL BARS	38"W. x 8"H. 15M TRANSVERSE BOTTOM BARS 34" LONG @ 20" o/c 3-15M LONGITUDINAL BARS	46"W. x 8"H. 15M TRANSVERSE BOTTOM BARS 42" LONG @ 16" o/c 3-15M LONGITUDINAL BARS	
WF3	26"W. x 8"H. 2-15M LONGITUDINAL BARS	30"W. x 8"H. 2-15M LONGITUDINAL BARS	34"W. x 8"H. 2-15M LONGITUDINAL BARS	42"W. x 8"H. 15M TRANSVERSE BOTTOM BARS 38" LONG @ 20" o/c 3-15M LONGITUDINAL BARS	
WF4	24"W. x 8"H. 2-15M LONGITUDINAL BARS	28"W. x 8"H. 2-15M LONGITUDINAL BARS	32"W. x 8"H. 2-15M LONGITUDINAL BARS	38"x8" DP. 15M TRANSVERSE BOTTOM BARS 34" LONG @ 20" o/c 3-15M LONGITUDINAL BARS	
WF5	24"W. x 8"H. 2-15M LONGITUDINAL BARS	24"W. x 8"H. 2-15M LONGITUDINAL BARS	26"W. x 8"H. 2-15M LONGITUDINAL BARS	34"x8" DP. 2-15M LONGITUDINAL BARS	
WF6	24"W. x 8"H. 2-15M LONGITUDINAL BARS	24"W. x 8"H. 2-15M LONGITUDINAL BARS	24"W. x 8"H. 2-15M LONGITUDINAL BARS	30"x8" DP. 2-15M LONGITUDINAL BARS	
WF7	20"W. x 8"H. 2-15M LONGITUDINAL BARS	20"W. x 8"H. 2-15M LONGITUDINAL BARS	20"W. x 8"H. 2-15M LONGITUDINAL BARS	24"x8" DP. 2-15M LONGITUDINAL BARS	
	PAI	FOOTING SCHED	JLE		
	ALLOWABLE SOIL BEARING CAR	PACITY / BEARING RESISTANCE	AT SLS FOR «SITE CLASS:D»	•	
POST FOOTINGS	100KPa	85KPa	75KPa	60KPa	
F1	36"W.x36"W.x10"H. 3-15M LONGITUDINAL BARS x 30" LONG EACH WAY	38"W.x38"W.x10"H. 3-15M LONGITUDINAL BARS x 32" LONG EACH WAY	40"W.x40"W.x10"H. 3-15M LONGITUDINAL BARS x 34" LONG EACH WAY	44"W.x44"W.x10"H. 3-15M LONGITUDINAL BARS x 38" LONG EACH WAY	
F2	24"W. x 24"W. x 10"H.	24"W. x 24"W. x 10"H.	24"W. x 24"W. x 10"H.	28"W. x 28"W. x 12"H.	

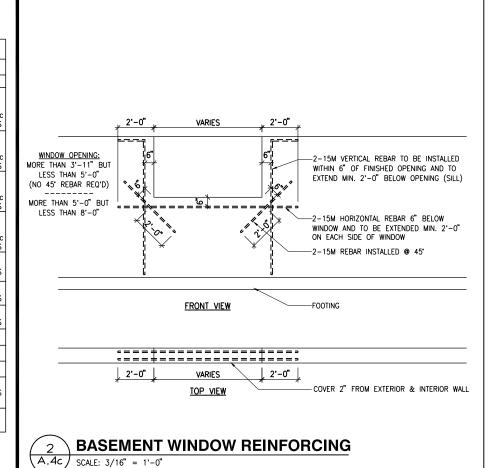

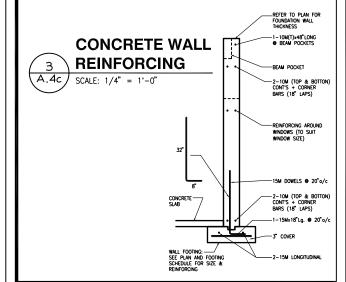

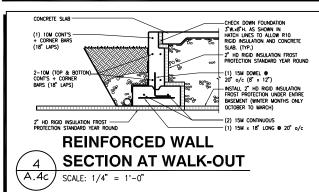

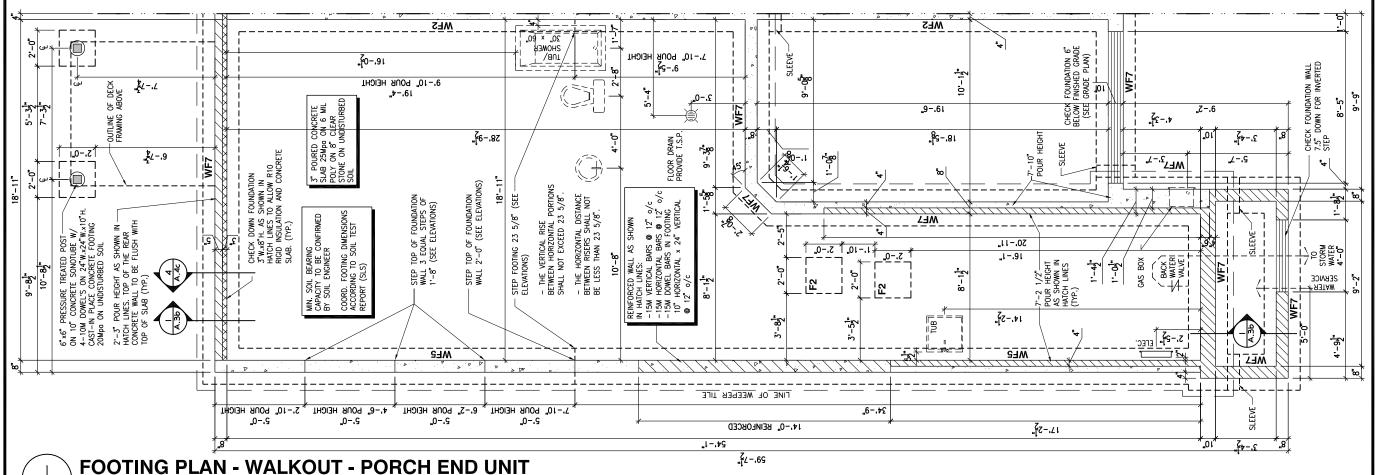

SCALE: 3/16" = 1'-0"

LOT: **XXXX** DATE: XX/XX/XXXX



DANIEL GUERIN., ARCHITECTURAL MANAGER FOR
MALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS
UND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BCIN #19896
- TARION REGISTRATION NUMBER #611
- SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM

his drawing is to be used in conjunction with schedule --1a and any 680's and May show only some of the Change 'Etailed on that document. Should the Drawings not show LL items contained on a schedule or Miss other items LTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

- FOOTINGS HAVE BEEN DESIGNED FOR THE ALLOWABLE SOIL BEARING CAPACITY OR BEARING RESISTANCE AT SLS AND DESIGN PARAMETERS OUTLINED IN A GEOTECHNICAL REPORT REPORT PREPARED BY PATERSON GROUP AND/OR OTHERS (AVAILABLE UPON REQUEST);
- BEARING STRATA TO BE INSPECTED AND THE BEARING VALUE AND UNDER SIDE OF FOOTING (USF) ELEVATION CONFIRMED BY GEOTECHNICAL CONSULTANT AT TIME OF EXCAVATION;
- THICKNESS OF L.W.F. IS SPECIFIED ON DRAWINGS.
  THICKNESS OF L.W.F. AT GARAGES, PORCHES AND PLACEMENT
  OF L.W.F. AT OTHER AREAS, IF REQUIRED, TO BE CONFIRMED
  AS PER GEOTECHNICAL CONSULTANTS RECOMMENDATIONS AT THE TIME OF EXCAVATION;
- FOR ALLOWABLE BEARING VALUES OUTSIDE OF THE FOOTING SCHEDULE, CONTACT THE STRUCTURAL ENGINEER FOR INSTRUCTIONS;
- CONCRETE STRENGTH @ 28 DAYS FOR FOOTINGS AND WALL = 20MPo AND CONCRETE FOR FOUNDATION WALLS SHOULD
- REINFORCING STEEL SHALL COMPLY TO G30.18 GRADE 400;
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE ARCHITECTURAL FOUNDATION PLAN FOR THE SPECIFIC MODEL AND ARCHITECTURAL SPECIFICATION.

2012 O.B.C. DRAWINGS

	REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
<b>-</b>	REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
-	REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
	REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
	NO.	DESCRIPTION	MM/DD/YYYY	BY

**FOOTING PLAN WALKOUT - PORCH END UNIT** 

3/16" = 1'-0"

XX/XX/XXXX SHEET


120 - THE HUNTLEY 2020 FOOTPRINT

A.4d


SCALE: 3/16" = 1'-0"


( A.4d *)* 


	FOOTING SCHEDULE					
	ALLOWABLE SOIL BEARING CAR	PACITY / BEARING RESISTANCE	E AT SLS FOR «SITE CLASS:D)	)		
WALL FOOTINGS	100KPa	85KPa	75KPa	60KPa		
WF1	30"W. x 8"H. 2-15M LONGITUDINAL BARS	36"W. x 8"H. 15M TRANSVERSE BOTTOM BARS 32" LONG @ 20" o/c 3-15M LONGITUDINAL BARS		48"W. x 8"H. 15M TRANSVERSE BOTTOM BARS 42" LONG @ 16" o/c 3-15M LONGITUDINAL BARS		
WF2	28"W. x 8"H. 2-15M LONGITUDINAL BARS	34"W. x 8"H. 2-15M LONGITUDINAL BARS	38"W. x 8"H. 15M TRANSVERSE BOTTOM BARS 34" LONG @ 20" o/c 3-15M LONGITUDINAL BARS	46"W. x 8"H. 15M TRANSVERSE BOTTOM BARS 42" LONG @ 16" o/c 3-15M LONGITUDINAL BARS		
WF3	26"W. x 8"H. 2-15M LONGITUDINAL BARS	30"W. x 8"H. 2-15M LONGITUDINAL BARS	34"W. x 8"H. 2-15M LONGITUDINAL BARS	3-15M LONGITUDINAL BARS		
WF4	24"W. x 8"H. 2-15M LONGITUDINAL BARS	28"W. x 8"H. 2-15M LONGITUDINAL BARS	32"W. x 8"H. 2-15M LONGITUDINAL BARS	38"x8" DP. 15M TRANSVERSE BOTTOM BARS 34" LONG @ 20" o/c 3-15M LONGITUDINAL BARS		
WF5	24"W. x 8"H. 2-15M LONGITUDINAL BARS	24"W. x 8"H. 2-15M LONGITUDINAL BARS	26"W. x 8"H. 2-15M LONGITUDINAL BARS	34"x8" DP. 2-15M LONGITUDINAL BARS		
WF6	24"W. x 8"H. 2-15M LONGITUDINAL BARS	24"W. x 8"H. 2-15M LONGITUDINAL BARS	24"W. x 8"H. 2-15M LONGITUDINAL BARS	30"x8" DP. 2-15M LONGITUDINAL BARS		
WF7	20"W. x 8"H. 2-15M LONGITUDINAL BARS	20"W. x 8"H. 2-15M LONGITUDINAL BARS	20"W. x 8"H. 2-15M LONGITUDINAL BARS	24"x8" DP. 2-15M LONGITUDINAL BARS		
	PAI	D FOOTING SCHED	JLE			
	ALLOWABLE SOIL BEARING CAR	PACITY / BEARING RESISTANCE	AT SLS FOR «SITE CLASS:D)	)		
POST FOOTINGS	100KPa	85KPa	75KPa	60KPa		
F1	36"W.x36"W.x10"H. 3-15M LONGITUDINAL BARS x 30" LONG EACH WAY	38"W.x38"W.x10"H. 3-15M LONGITUDINAL BARS x 32" LONG EACH WAY	40"W.x40"W.x10"H. 3-15M LONGITUDINAL BARS x 34" LONG EACH WAY	44"W.x44"W.x10"H. 3-15M LONGITUDINAL BARS x 38" LONG EACH WAY		
F2	24"W. x 24"W. x 10"H.	24"W. x 24"W. x 10"H.	24"W. x 24"W. x 10"H.	28"W. x 28"W. x 12"H.		

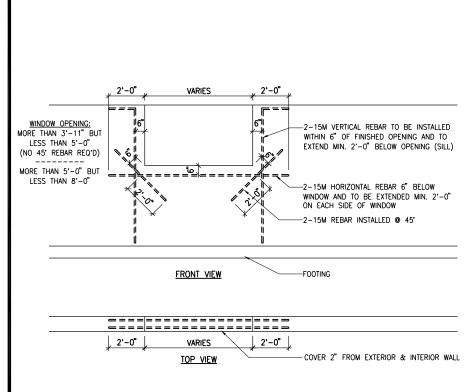

**BASEMENT WINDOW REINFORCING** 

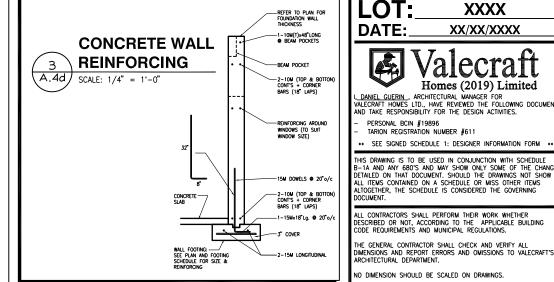

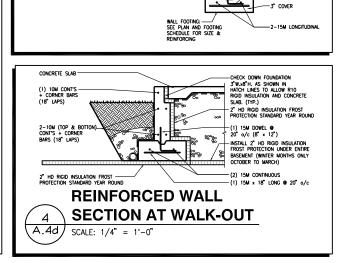

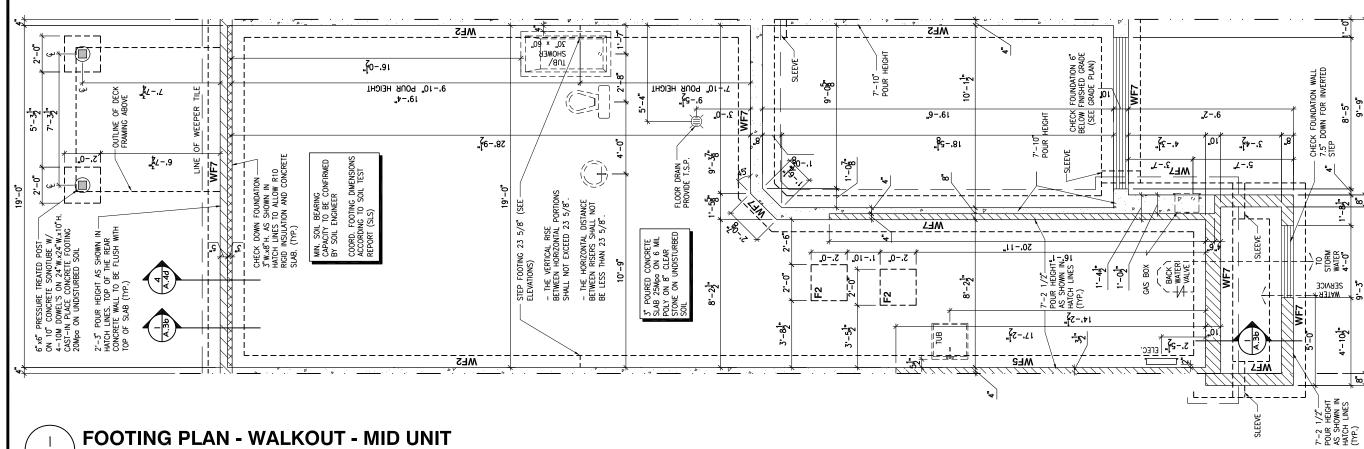

 $\begin{pmatrix} 2 \\ A.4d \end{pmatrix}$ 

SCALE: 3/16" = 1'-0"

2012 O.B.C. DRAWINGS

REV-4 NEW STANDARD DRWG MODIFICATION 01/01/2021 DOYON REV-3 AS PER STRUCTURAL REVIEW 03/20/2019 VH REV-2 AS PER STRUCTURAL REVIEW 11/07/2018 VH 
 REV-1
 NEW STANDARD DRWG MODIFICATION
 11/13/2017
 MAD

 NO.
 DESCRIPTION
 MM/DD/YYYY
 BY

> **FOOTING PLAN WALKOUT - MID UNIT**

3/16" = 1'-0"

120 - THE HUNTLEY 2020 FOOTPRINT

LOT:

PERSONAL BCIN #19896

TARION REGISTRATION NUMBER #611

DATE:

**XXXX** 

XX/XX/XXXX

Homes (2019) Limited

DANIEL GUERIN., ARCHITECTURAL MANAGER FOR
MALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS
UND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM

his drawing is to be used in conjunction with schedule --1a and any 680's and May show only some of the Change 'Etailed on that document. Should the Drawings not show LL items contained on a schedule or Miss other items

LTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

- FOOTINGS HAVE BEEN DESIGNED FOR THE ALLOWABLE SOIL BEARING CAPACITY OR BEARING RESISTANCE AT SLS AND DESIGN PARAMETERS OUTLINED IN A GEOTECHNICAL REPORT

- BEARING STRATA TO BE INSPECTED AND THE BEARING VALUE AND UNDER SIDE OF FOOTING (USF) ELEVATION CONFIRMED BY GEOTECHNICAL CONSULTANT AT TIME OF EXCAVATION;

- THICKNESS OF L.W.F. IS SPECIFIED ON DRAWINGS.
THICKNESS OF L.W.F. AT GARAGES, PORCHES AND PLACEMENT
OF L.W.F. AT OTHER AREAS, IF REQUIRED, TO BE CONFIRMED
AS PER GEOTECHNICAL CONSULTANTS RECOMMENDATIONS AT

- FOR ALLOWABLE BEARING VALUES OUTSIDE OF THE FOOTING SCHEDULE, CONTACT THE STRUCTURAL ENGINEER FOR INSTRUCTIONS;

- CONCRETE STRENGTH @ 28 DAYS FOR FOOTINGS AND WALL = 20MPa AND CONCRETE FOR FOUNDATION WALLS SHOULD HAVE 6% ( $\pm$  1%) AIR ENTRAINMENT; - REINFORCING STEEL SHALL COMPLY TO G30.18 GRADE 400; - THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE ARCHITECTURAL FOUNDATION PLAN FOR THE SPECIFIC MODEL

REPORT PREPARED BY PATERSON GROUP AND/OR OTHERS

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

(AVAILABLE UPON REQUEST);

THE TIME OF EXCAVATION;


AND ARCHITECTURAL SPECIFICATION.


SHEET A.4e


XX/XX/XXXX


SCALE: 3/16" = 1'-0"


(A.4e)

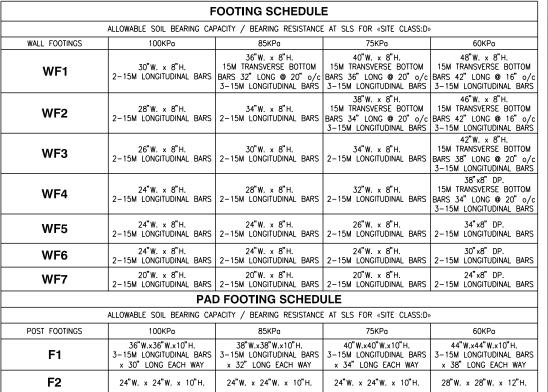

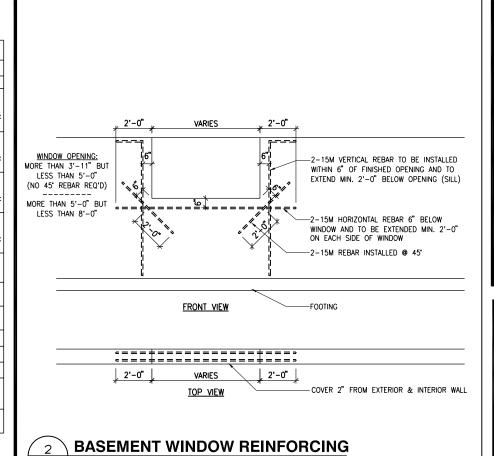

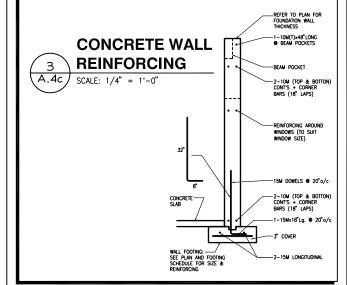

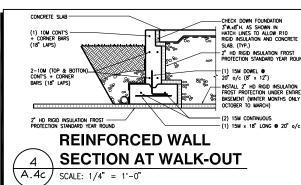

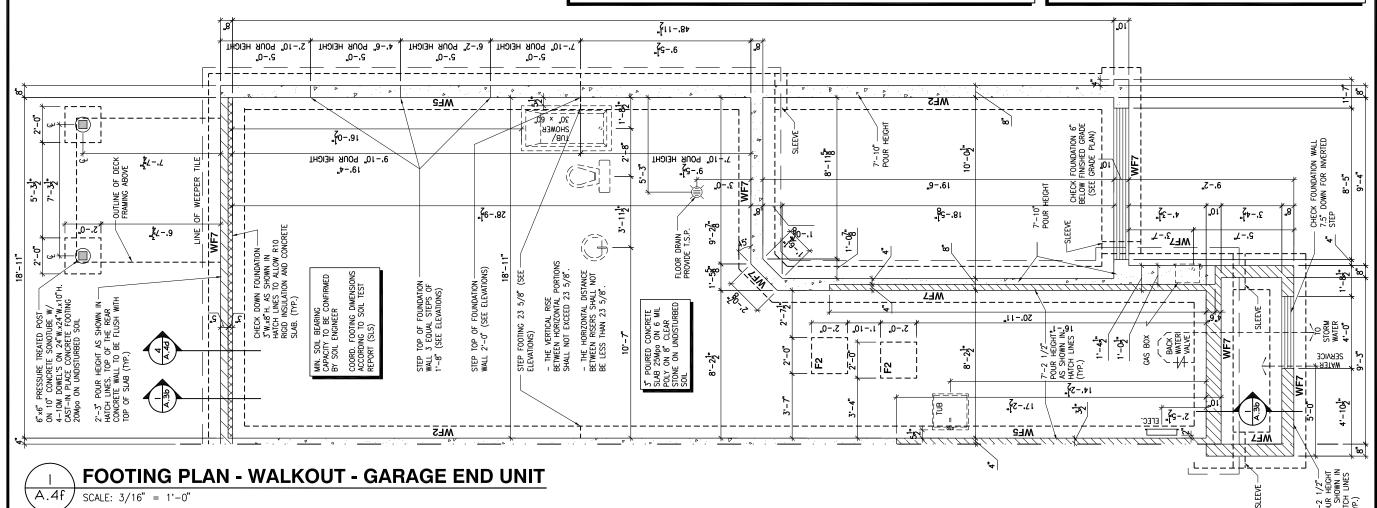

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX

Homes (2019) Limited

DANIEL GUERIN , ARCHITECTURAL MANAGER FOR ALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS ND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BCIN #19896
- TARION REGISTRATION NUMBER #611
- SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM

- 1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE ETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW LL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS LTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER
DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

IO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

- Footings have been designed for the allowable soil Bearing Capacity or Bearing resistance at SLS and Design parameters outlined in a geotechnical report REPORT PREPARED BY PATERSON GROUP AND/OR OTHERS (AVAILABLE UPON REQUEST);
- BEARING STRATA TO BE INSPECTED AND THE BEARING VALUE AND UNDER SIDE OF FOOTING (USF) ELEVATION CONFIRMED BY GEOTECHNICAL CONSULTANT AT TIME OF EXCAVATION;
- THICKNESS OF L.W.F. IS SPECIFIED ON DRAWINGS.
  THICKNESS OF L.W.F. AT GARAGES, PORCHES AND PLACEMENT
  OF L.W.F. AT OTHER AREAS, IF REQUIRED, TO BE CONFIRMED AS PER GEOTECHNICAL CONSULTANTS RECOMMENDATIONS AT THE TIME OF EXCAVATION;
- FOR ALLOWABLE BEARING VALUES OUTSIDE OF THE FOOTING SCHEDULE, CONTACT THE STRUCTURAL ENGINEER FOR INSTRUCTIONS;
- CONCRETE STRENGTH @ 28 DAYS FOR FOOTINGS AND WALL = 20MPo AND CONCRETE FOR FOUNDATION WALLS SHOULD
- REINFORCING STEEL SHALL COMPLY TO G30.18 GRADE 400;
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE ARCHITECTURAL FOUNDATION PLAN FOR THE SPECIFIC MODEL AND ARCHITECTURAL SPECIFICATION.

2012 O.B.C. DRAWINGS

ı				
	REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
	REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
	REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
	REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
ı	NO.	DESCRIPTION	MM/DD/YYYY	BY

**FOOTING PLAN WALKOUT - GARAGE END UNIT** 

3/16" = 1'-0"

XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT

SHEET A.4f (STANDARD DRAWINGS)

- 11 1/8" PRE-ENG. OPEN JOIST TRIFORCE @ 19.2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR S1) ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

#### GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS

### WALK-OUT DECK FRAMING NOTES:

- $2^{\prime\prime}\times10^{\prime\prime}$  solid blocking at ledger nailed to Rim Board and top plates. Install at the same time as comfort board and install tyck homewrap or equivalent continuous over solid blocking
- 2"x10" PRESSURE TREATED LEDGER. FASTEN TOP THROUGH 2"x10" SOLID BLOCKING AND RIM BOARD, FASTEN BOTTOM THROUGH 2"x10" SOLID BLOCKING AND TOP PLATES
  WITH 3/8" x 6" LAG SCREWS AND WASHERS @ 16" o/c
- RIM BOARD 2"x10" PRESSURE TREATED TO CANTILEVER POSTS 1  $\frac{1}{2}$ " ALL AROUND
- $\langle 4 \rangle$ 2"x10" PRESSURE TREATED JOISTS @ 16" o/c
- $\langle 5 \rangle$ 3-2"x10" PRESSURE TREATED (FLUSH)
- JOIST HANGERS AT EVERY JOIST CONNECTION

- ALL CONCRETE TO HAVE A MINIMUM COMPRESSIVE STRENGHT OF 3000 P.S.I. (21MPa) AT 28 DAYS;

- ALL GARAGE FLOOR SLAB TO BE 4" THICK AND 4650 P.S.I. c/w 5 TO 8% AIR ENTRAINED & TO BE SLOPED TOWARDS THE EXTERIOR (MIN 2% SLOPE);

- CONCRETE FOOTINGS MUST BE PLACED ON UNDISTERBED OR COMPACTED SOIL TO AN ELEVATION BELOW FROST PENETRATION:

- FOUNDATION WALL SHALL NOT BE BACKFILLED UNTIL CONCRETE HAS REACHED ITS SPECIFIED 28 DAYS STRENGHT AND STRUCTURAL FLOOR FRAMING (INCLUDING PLYWOOD SUBFLOOR) REQUIRED TO STABILIZE THE WALLS ARE COMPLETED AND


- FOOTINGS DIMENSIONS ARE BASED ON THE SOIL BEARING CAPACITY PROVIDED BY THE GEOTECHNICAL ENGINEER.


#### BASEMENT NOTE:

- IF A BEDROOM IS ADDED IN THE BASEMENT, THE ROOM MUST CONFORM WITH

1) EXCEPT WHERE A DOOR ON THE SAME FLOOR LEVEL AS THE BEDROOM PROVIDES DIRECT ACCESS TO THE EXTERIOR, EVERY FLOOR LEVEL CONTAINING A BEDROOM IN A SUITE SHALL BE PROVIDED WITH AT LEAST 1 OUTISE WINDOW THAT:

A) IS OPENABLE FROM THE INSIDE WITHOUT THE USE OF TOOLS; AND B) PROVIDES AN INDIVIDUAL UNORSTRUCTED OPEN PORTION HAVING A MINIMUM AREA OF 0,38m2 (3,8 SQ.FT.) WITH NO DIMENSIONS LESS THAN 380mm (15IN)

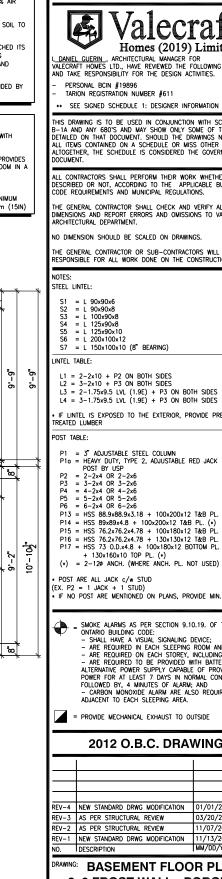

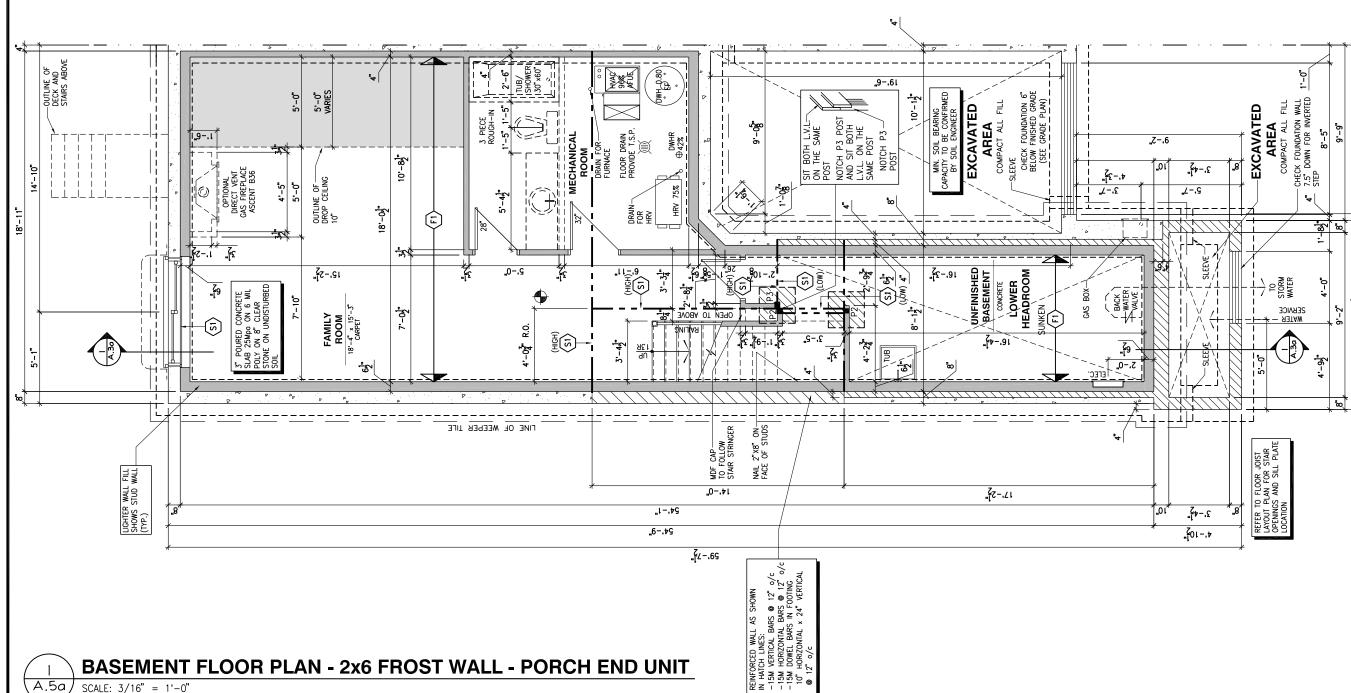

DATE: XX/XX/XXXX Homes (2019) Limited

DANIEL GUERIN , ARCHITECTURAL MANAGER FOR
ALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS
ND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

XXXX

PERSONAL BCIN #19896

LOT:

TARION REGISTRATION NUMBER #611

SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM

I-- IA AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE ETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW LL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS LTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

S7 = L 150x100x10 (8" BEARING)

L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES

 $L4 = 3-1.75 \times 9.5$  LVL (1.9E) + P3 ON BOTH SIDES

• IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE

P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)

P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*)

P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL.

(\*) = 2-120 ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

. IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

SMOKE ALARMS AS PER SECTION 9.10.19. OF THE
ONTARIO BUILDING CODE:

- SHALL HAVE A VISUAL SIGNALING DEVICE;

- ARE REQUIRED IN EACH SIEEPING ROOM AND HALLWAY;

- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT,

- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN
ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING

POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND — CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

# 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

## TAWING: BASEMENT FLOOR PLAN 2x6 FROST WALL - PORCH END

3/16" = 1'-0" XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT

SHEET A.5a

SCALE: 3/16" = 1'-0"

- 11 %" PRE-ENG. OPEN JOIST TRIFORCE @ 19.2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR S1) ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

빏

#### GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS

### WALK-OUT DECK FRAMING NOTES:

- $2^{\prime\prime}\times10^{\prime\prime}$  solid blocking at ledger nailed to Rim Board and top plates. Install at the same time as comfort board and install tyck homewrap or equivalent continuous over solid blocking
- 2"x10" PRESSURE TREATED LEDGER. FASTEN TOP THROUGH 2"x10" SOLID BLOCKING AND RIM BOARD, FASTEN BOTTOM THROUGH 2"x10" SOLID BLOCKING AND TOP PLATES
  WITH 3/8" x 6" LAG SCREWS AND WASHERS @ 16" o/c
- RIM BOARD 2"x10" PRESSURE TREATED TO CANTILEVER POSTS 1  $\frac{1}{2}$ " ALL AROUND
- $\langle 4 \rangle$ 2"x10" PRESSURE TREATED JOISTS @ 16" o/c
- $\langle 5 \rangle$ 3-2"x10" PRESSURE TREATED (FLUSH)
- JOIST HANGERS AT EVERY JOIST CONNECTION

.9-.61

- ALL CONCRETE TO HAVE A MINIMUM COMPRESSIVE STRENGHT OF 3000 P.S.I. (21MPo) AT 28 DAYS;

- ALL GARAGE FLOOR SLAB TO BE 4" THICK AND 4650 P.S.I. c/w 5 TO 8% AIR ENTRAINED & TO BE SLOPED TOWARDS THE EXTERIOR (MIN 2% SLOPE);

- CONCRETE FOOTINGS MUST BE PLACED ON UNDISTERBED OR COMPACTED SOIL TO AN ELEVATION BELOW FROST PENETRATION:

- FOUNDATION WALL SHALL NOT BE BACKFILLED UNTIL CONCRETE HAS REACHED ITS SPECIFIED 28 DAYS STRENGHT AND STRUCTURAL FLOOR FRAMING (INCLUDING PLYWOOD SUBFLOOR) REQUIRED TO STABILIZE THE WALLS ARE COMPLETED AND

- FOOTINGS DIMENSIONS ARE BASED ON THE SOIL BEARING CAPACITY PROVIDED BY THE GEOTECHNICAL ENGINEER.

#### BASEMENT NOTE:

- IF A BEDROOM IS ADDED IN THE BASEMENT, THE ROOM MUST CONFORM WITH

1) EXCEPT WHERE A DOOR ON THE SAME FLOOR LEVEL AS THE BEDROOM PROVIDES DIRECT ACCESS TO THE EXTERIOR, EVERY FLOOR LEVEL CONTAINING A BEDROOM IN A SUITE SHALL BE PROVIDED WITH AT LEAST 1 OUTISE WINDOW THAT:

A) IS OPENABLE FROM THE INSIDE WITHOUT THE USE OF TOOLS; AND B) PROVIDES AN INDIVIDUAL UNORSTRUCTED OPEN PORTION HAVING A MINIMUM AREA OF 0,38m2 (3,8 SQ.FT.) WITH NO DIMENSIONS LESS THAN 380mm (15IN)

LOT: **XXXX** DATE: XX/XX/XXXX

Homes (2019) Limited

DANIEL GUERIN , ARCHITECTURAL MANAGER FOR
ALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS
ND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BOIN #19896
- TARION REGISTRATION NUMBER #611

IS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE I-- IA AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE ETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW LL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS LTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING OCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

## NOTES: STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10
- $S6 = L 200 \times 100 \times 12$
- S7 = L 150x100x10 (8" BEARING)

#### LINTEL TABLE:

- L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES
- L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES L4 = 3-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES
- IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE

### POST TABLE:

P1 = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-244 OR 2-2x6
P3 = 3-2x4 OR 3-2x6
P4 = 4-2x4 OR 4-2x6
P5 = 5-2x4 OR 5-2x6
P6 = 6-2x4 OR 6-2x6
P13 = HSS R8 0x88 0x 18 x 100x200x12 T&B P1

- P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)
- P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*)
- P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL.

(\*) = 2-120 ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)
• IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

SMOKE ALARMS AS PER SECTION 9.10.19. OF THE
ONTARIO BUILDING CODE:

- SHALL HAVE A VISUAL SIGNALING DEVICE;

- ARE REQUIRED IN EACH SIEEPING ROOM AND HALLWAY;

- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT,

- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN
ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING

POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND — CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

## 2012 O.B.C. DRAWINGS

		1	
REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

## AWING: BASEMENT FLOOR PLAN

2x6 FROST WALL - MID UNIT

3/16" = 1'-0" XX/XX/XXXX SHEET


A.5b

120 - THE HUNTLEY

2020 FOOTPRINT

(STANDARD DRAWINGS)

SCALE: 3/16" = 1'-0"

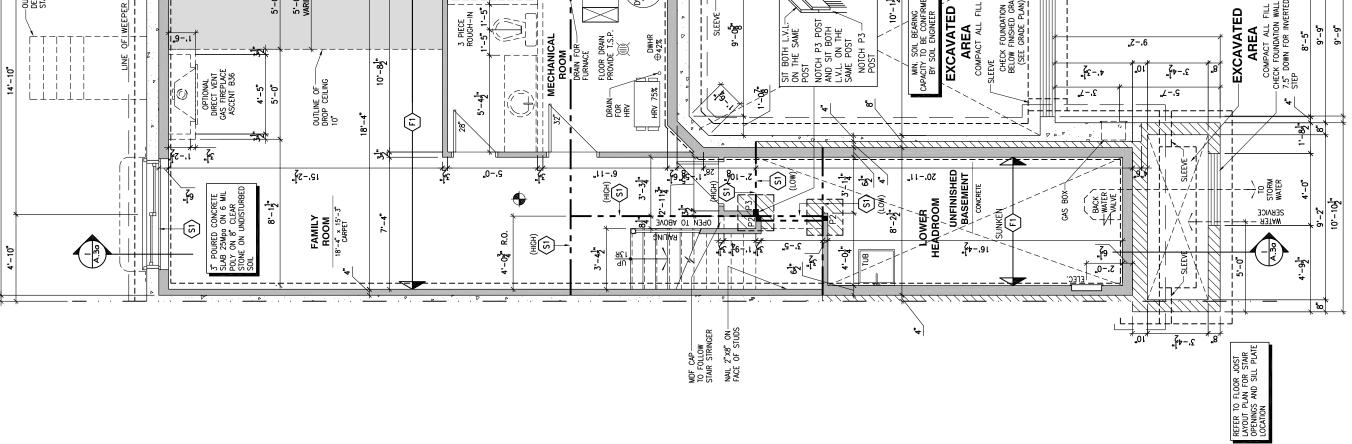

H-0.80

HVAC 96% AFUE

BASEMENT FLOOR PLAN - 2x6 FROST WALL - MID UNIT (A.5b

- 11 1/8" PRE-ENG. OPEN JOIST TRIFORCE @ 19.2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR S1) ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

#### GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS

### WALK-OUT DECK FRAMING NOTES:

- $2^{\prime\prime}\times10^{\prime\prime}$  solid blocking at ledger nailed to Rim Board and top plates. Install at the same time as comfort board and install tyck homewrap or equivalent continuous over solid blocking
- 2"x10" PRESSURE TREATED LEDGER. FASTEN TOP THROUGH 2"x10" SOLID BLOCKING AND RIM BOARD, FASTEN BOTTOM THROUGH 2"x10" SOLID BLOCKING AND TOP PLATES
  WITH 3/8" x 6" LAG SCREWS AND WASHERS @ 16" o/c
- RIM BOARD 2"x10" PRESSURE TREATED TO CANTILEVER POSTS 1 ½" ALL AROUND
- $\langle 4 \rangle$ 2"x10" PRESSURE TREATED JOISTS @ 16" o/c
- $\langle 5 \rangle$ 3-2"x10" PRESSURE TREATED (FLUSH)
- JOIST HANGERS AT EVERY JOIST CONNECTION

- ALL GARAGE FLOOR SLAB TO BE 4" THICK AND 4650 P.S.I. c/w 5 TO 8% AIR ENTRAINED & TO BE SLOPED TOWARDS THE EXTERIOR (MIN 2% SLOPE);

- CONCRETE FOOTINGS MUST BE PLACED ON UNDISTERBED OR COMPACTED SOIL TO AN ELEVATION BELOW FROST PENETRATION:

- FOUNDATION WALL SHALL NOT BE BACKFILLED UNTIL CONCRETE HAS REACHED ITS SPECIFIED 28 DAYS STRENGHT AND STRUCTURAL FLOOR FRAMING (INCLUDING PLYWOOD SUBFLOOR) REQUIRED TO STABILIZE THE WALLS ARE COMPLETED AND


- FOOTINGS DIMENSIONS ARE BASED ON THE SOIL BEARING CAPACITY PROVIDED BY THE GEOTECHNICAL ENGINEER.

#### BASEMENT NOTE:

- IF A BEDROOM IS ADDED IN THE BASEMENT, THE ROOM MUST CONFORM WITH

1) EXCEPT WHERE A DOOR ON THE SAME FLOOR LEVEL AS THE BEDROOM PROVIDES DIRECT ACCESS TO THE EXTERIOR, EVERY FLOOR LEVEL CONTAINING A BEDROOM IN A SUITE SHALL BE PROVIDED WITH AT LEAST 1 OUTISE WINDOW THAT:

A) IS OPENABLE FROM THE INSIDE WITHOUT THE USE OF TOOLS; AND B) PROVIDES AN INDIVIDUAL UNORSTRUCTED OPEN PORTION HAVING A MINIMUM AREA OF 0,38m2 (3,8 SQ.FT.) WITH NO DIMENSIONS LESS THAN 380mm (15IN)

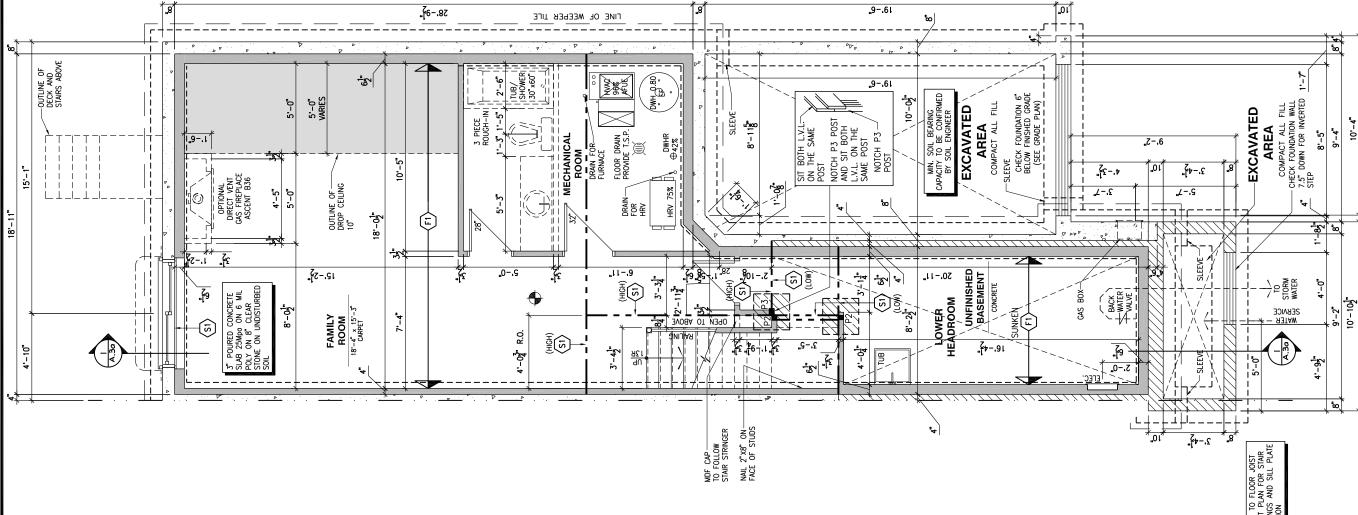



BASEMENT FLOOR PLAN - 2x6 FROST WALL - GARAGE END UNIT

SCALE: 3/16" = 1'-0"

- ALL CONCRETE TO HAVE A MINIMUM COMPRESSIVE STRENGHT OF 3000 P.S.I. (21MPa) AT 28 DAYS;

Homes (2019) Limited

DANIEL GUERIN , ARCHITECTURAL MANAGER FOR
ALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS
ND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

XXXX

XX/XX/XXXX

PERSONAL BCIN #19896

LOT:

DATE:

TARION REGISTRATION NUMBER #611

SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM

I-- IA AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE ETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW LL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS LTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING OCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

# NOTES: STEEL LINTEL: S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10

S7 = L 150x100x10 (8" BEARING) LINTEL TABLE:

 $S6 = L 200 \times 100 \times 12$ 

L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES

L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES

L4 = 3-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES

IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE

POST TABLE:

P1 = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAYY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-224 OR 2-246
P3 = 3-2x4 OR 3-2x6

P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)

P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*)

P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL.

(\*) = 2-120 ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)
• IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

SMOKE ALARMS AS PER SECTION 9.10.19. OF THE
ONTARIO BUILDING CODE:

- SHALL HAVE A VISUAL SIGNALING DEVICE;

- ARE REQUIRED IN EACH SIEEPING ROOM AND HALLWAY;

- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT,

- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN
ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING

POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND — CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

# 2012 O.B.C. DRAWINGS

		1	
REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

## RAWING: BASEMENT FLOOR PLAN

2x6 FROST WALL - GARAGE END

3/16" = 1'-0"

120 - THE HUNTLEY 2020 FOOTPRINT

A.5c

XX/XX/XXXX

SHEET

- 11 %" PRE-ENG. OPEN JOIST TRIFORCE @ 19.2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR S1) ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

#### GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE FOUNDATION WALL OR SUPPORTING MEMBER
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS

### WALK-OUT DECK FRAMING NOTES:

- $2^{\prime\prime}\times10^{\prime\prime}$  solid blocking at ledger nailed to Rim Board and top plates. Install at the same time as comfort board and install tyck homewrap or equivalent continuous over solid blocking
- 2"x10" PRESSURE TREATED LEDGER. FASTEN TOP THROUGH 2"x10" SOLID BLOCKING AND RIM BOARD, FASTEN BOTTOM THROUGH 2"x10" SOLID BLOCKING AND TOP PLATES
  WITH 3/8" x 6" LAG SCREWS AND WASHERS @ 16" o/c
- RIM BOARD 2"x10" PRESSURE TREATED TO CANTILEVER POSTS 1  $\frac{1}{2}$ " ALL AROUND
- $\langle 4 \rangle$ 2"x10" PRESSURE TREATED JOISTS @ 16" o/c
- $\langle 5 \rangle$ 3-2"x10" PRESSURE TREATED (FLUSH)
- JOIST HANGERS AT EVERY JOIST CONNECTION

- ALL GARAGE FLOOR SLAB TO BE 4" THICK AND 4650 P.S.I. c/w 5 TO 8% AIR ENTRAINED & TO BE SLOPED TOWARDS THE EXTERIOR (MIN 2% SLOPE);

- CONCRETE FOOTINGS MUST BE PLACED ON UNDISTERBED OR COMPACTED SOIL TO AN ELEVATION BELOW FROST PENETRATION:

- FOUNDATION WALL SHALL NOT BE BACKFILLED UNTIL CONCRETE HAS REACHED ITS SPECIFIED 28 DAYS STRENGHT AND STRUCTURAL FLOOR FRAMING (INCLUDING PLYWOOD SUBFLOOR) REQUIRED TO STABILIZE THE WALLS ARE COMPLETED AND


– FOOTINGS DIMENSIONS ARE BASED ON THE SOIL BEARING CAPACITY PROVIDED BY THE GEOTECHNICAL ENGINEER.

#### BASEMENT NOTE:

- IF A BEDROOM IS ADDED IN THE BASEMENT, THE ROOM MUST CONFORM WITH

1) EXCEPT WHERE A DOOR ON THE SAME FLOOR LEVEL AS THE BEDROOM PROVIDES DIRECT ACCESS TO THE EXTERIOR, EVERY FLOOR LEVEL CONTAINING A BEDROOM IN A SUITE SHALL BE PROVIDED WITH AT LEAST 1 OUTISE WINDOW THAT:

A) IS OPENABLE FROM THE INSIDE WITHOUT THE USE OF TOOLS; AND B) PROVIDES AN INDIVIDUAL UNORSTRUCTED OPEN PORTION HAVING A MINIMUM AREA OF 0,38m2 (3,8 SQ.FT.) WITH NO DIMENSIONS LESS THAN 380mm (15IN)

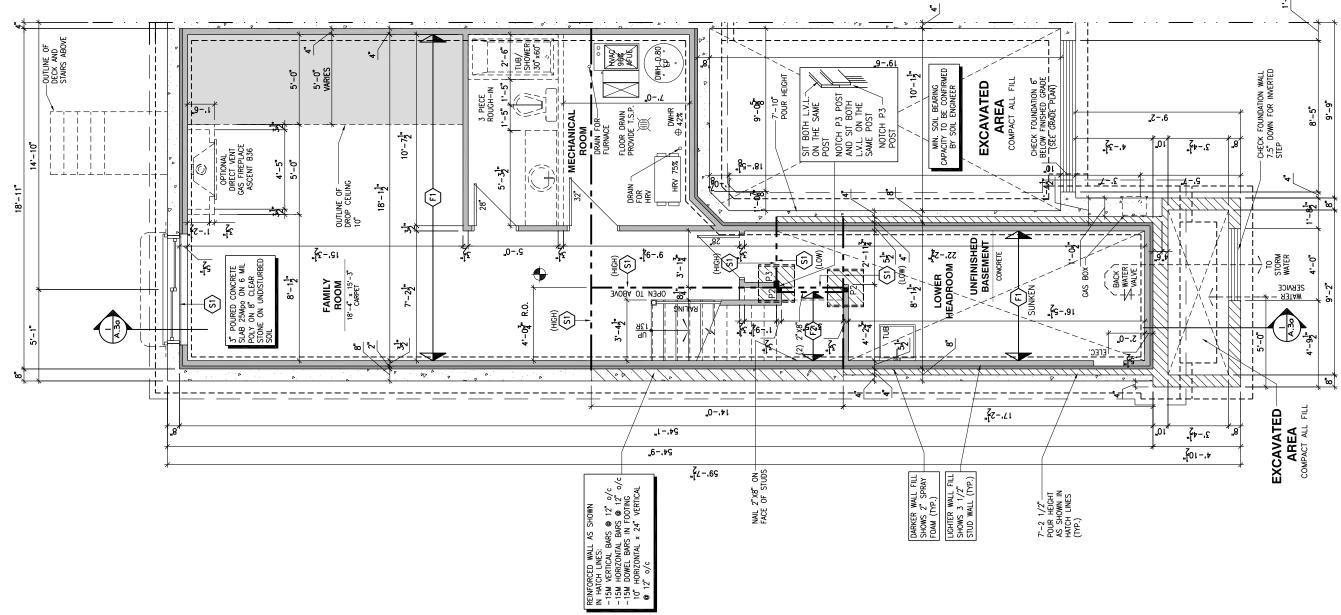

(A.5d SCALE: 3/16" = 1'-0"

BASEMENT FLOOR PLAN - ENERGY STAR - SPRAY FOAM AND 2x4 FROST WALL - PORCH END UNIT

- ALL CONCRETE TO HAVE A MINIMUM COMPRESSIVE STRENGHT OF 3000 P.S.I. (21MPo) AT 28 DAYS;

Homes (2019) Limited DANIEL GUERIN , ARCHITECTURAL MANAGER FOR
ALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS
ND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

XXXX

XX/XX/XXXX

PERSONAL BOIN #19896

LOT:

DATE:

TARION REGISTRATION NUMBER #611

SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM

-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE ETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW L ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS LTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING OCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

HE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

#### NOTES: STEEL LINTEL:

S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x10 S5 = L 125x90x10

 $S6 = L 200 \times 100 \times 12$ S7 = L 150x100x10 (8" BEARING)

### INTEL TABLE:

L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES

L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES

• IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

#### POST TABLE:

P1 = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP

P2 = 2-2x4 OR 2-2x6 P3 = 3-2x4 OR 3-2x6

P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)

P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*)

P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL.

(\*) = 2-12¢ ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)

. IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

= SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
- SHALL HAVE A VISUAL SIGNALING DEVICE;
- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;
- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;
- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING

POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND — CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

### 2012 O.B.C. DRAWINGS

-			
REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYO
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION		MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

## AWING: BASEMENT FLOOR PLAN

3/16" = 1'-0" XX/XX/XXXX SHEET

**ENERGY STAR - PORCH END** 

120 - THE HUNTLEY 2020 FOOTPRINT

A.5d

- 11 %" PRE-ENG. OPEN JOIST TRIFORCE @ 19.2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR S1) ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

#### GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE FOUNDATION WALL OR SUPPORTING MEMBER
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING

OUTLI DROP 10"

12,-10,

2<mark>7, 1, -2</mark>ξ

3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS

### WALK-OUT DECK FRAMING NOTES:

- $2^{\prime\prime}\times10^{\prime\prime}$  solid blocking at ledger nailed to Rim Board and top plates. Install at the same time as comfort board and install tyck homewrap or equivalent continuous over solid blocking
- THROUGH 2"x10" SOLID BLOCKING AND TOP PLATES
  WITH 3/8" x 6" LAG SCREWS AND WASHERS @ 16" o/c
- JOIST HANGERS AT EVERY JOIST CONNECTION

A SO A

~ ~

کے

.<del>.†</del>6-.6

2"x8" ON-OF STUDS

(S1)

S E

. φ

 $3.72\frac{1}{4}$ 

-<sup>1</sup>2√ .4

.11-.02

LOWER HEADROC

16'-5<mark>]"</mark>

2"x10" PRESSURE TREATED LEDGER. FASTEN TOP THROUGH 2"x10" SOLID BLOCKING AND RIM BOARD, FASTEN BOTTOM

RIM BOARD 2"x10" PRESSURE TREATED TO CANTILEVER POSTS 1  $\frac{1}{2}$ " ALL AROUND

 $\langle 4 \rangle$ 2"x10" PRESSURE TREATED JOISTS @ 16" o/c

 $\langle 5 \rangle$ 3-2"x10" PRESSURE TREATED (FLUSH) - ALL CONCRETE TO HAVE A MINIMUM COMPRESSIVE STRENGHT OF 3000 P.S.I. (21MPo) AT 28 DAYS;

- ALL GARAGE FLOOR SLAB TO BE 4" THICK AND 4650 P.S.I. c/w 5 TO 8% AIR ENTRAINED & TO BE SLOPED TOWARDS THE EXTERIOR (MIN 2% SLOPE);

- CONCRETE FOOTINGS MUST BE PLACED ON UNDISTERBED OR COMPACTED SOIL TO AN ELEVATION BELOW FROST PENETRATION:

- FOUNDATION WALL SHALL NOT BE BACKFILLED UNTIL CONCRETE HAS REACHED ITS SPECIFIED 28 DAYS STRENGHT AND STRUCTURAL FLOOR FRAMING (INCLUDING PLYWOOD SUBFLOOR) REQUIRED TO STABILIZE THE WALLS ARE COMPLETED AND FULLY NAILED AND ANCHORED:

- FOOTINGS DIMENSIONS ARE BASED ON THE SOIL BEARING CAPACITY PROVIDED BY THE GEOTECHNICAL ENGINEER.

#### BASEMENT NOTE:

- IF A BEDROOM IS ADDED IN THE BASEMENT, THE ROOM MUST CONFORM WITH

1) EXCEPT WHERE A DOOR ON THE SAME FLOOR LEVEL AS THE BEDROOM PROVIDES DIRECT ACCESS TO THE EXTERIOR, EVERY FLOOR LEVEL CONTAINING A BEDROOM IN A SUITE SHALL BE PROVIDED WITH AT LEAST 1 OUTISE WINDOW THAT:

A) IS OPENABLE FROM THE INSIDE WITHOUT THE USE OF TOOLS; AND B) PROVIDES AN INDIVIDUAL UNORSTRUCTED OPEN PORTION HAVING A MINIMUM AREA OF 0,38m2 (3,8 SQ.FT.) WITH NO DIMENSIONS LESS THAN 380mm (15IN)

3.-4<sup>]</sup>"

4.-10<mark>5..</mark>

5،-۲

Z.-0<u>.</u>

JELEC.

TO FLOOR JOIST T PLAN FOR STAIR NGS AND SILL PLATE

EXCAVATED
AREA
COMPACT ALL FILL

SERVICE — A3TAW

1/2" — HEIGHT HOWN IN

LOT: **XXXX** DATE: XX/XX/XXXX

Homes (2019) Limited

DANIEL GUERIN , ARCHITECTURAL MANAGER FOR
ALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS
ND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

PERSONAL BCIN #19896

TARION REGISTRATION NUMBER #611

IS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE I-- IA AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE ETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW LL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS LTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING OCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

## NOTES: STEEL LINTEL: S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10 $S6 = L 200 \times 100 \times 12$ S7 = L 150x100x10 (8" BEARING)

#### INTEL TABLE:

L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES

L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES

• IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

#### POST TARLE:

P1 = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-224 OR 2-246
P3 = 3-2x4 OR 3-2x6

P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)

P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*)

P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL.

(\*) = 2-12¢ ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)
• IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

= SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
- SHALL HAVE A VISUAL SIGNALING DEVICE;
- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;
- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;
- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING

POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND — CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

# 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

## AWING: BASEMENT FLOOR PLAN

**ENERGY STAR - MID UNIT** 

3/16" = 1'-0"

120 - THE HUNTLEY

2020 FOOTPRINT

(STANDARD DRAWINGS)

A.5e

XX/XX/XXXX SHEET

BASEMENT FLOOR PLAN - ENERGY STAR - SPRAY FOAM AND 2x4 FROST WALL - MID UNIT

5'-32"

SCALE: 3/16" = 1'-0"

- 11 %" PRE-ENG. OPEN JOIST TRIFORCE @ 19.2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR S1) ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

#### GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE FOUNDATION WALL OR SUPPORTING MEMBER
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS

### WALK-OUT DECK FRAMING NOTES:

- $2^{\prime\prime}\times10^{\prime\prime}$  solid blocking at ledger nailed to Rim Board and top plates. Install at the same time as comfort board and install typek homewrap or equivalent continuous over solid blocking

- $\langle 5 \rangle$ 3-2"x10" PRESSURE TREATED (FLUSH)
- JOIST HANGERS AT EVERY JOIST CONNECTION

2"x10" PRESSURE TREATED LEDGER. FASTEN TOP THROUGH 2"x10" SOLID BLOCKING AND RIM BOARD, FASTEN BOTTOM THROUGH 2"x10" SOLID BLOCKING AND TOP PLATES
WITH 3/8" x 6" LAG SCREWS AND WASHERS @ 16" o/c

RIM BOARD 2"x10" PRESSURE TREATED TO CANTILEVER POSTS 1  $\frac{1}{2}$ " ALL AROUND

 $\langle 4 \rangle$ 2"x10" PRESSURE TREATED JOISTS @ 16" o/c

- ALL CONCRETE TO HAVE A MINIMUM COMPRESSIVE STRENGHT OF 3000 P.S.I. (21MPa) AT 28 DAYS;

- ALL GARAGE FLOOR SLAB TO BE 4" THICK AND 4650 P.S.I. c/w 5 TO 8% AIR ENTRAINED & TO BE SLOPED TOWARDS THE EXTERIOR (MIN 2% SLOPE);

- CONCRETE FOOTINGS MUST BE PLACED ON UNDISTERBED OR COMPACTED SOIL TO AN ELEVATION BELOW FROST PENETRATION;

- FOUNDATION WALL SHALL NOT BE BACKFILLED UNTIL CONCRETE HAS REACHED ITS SPECIFIED 28 DAYS STRENGHT AND STRUCTURAL FLOOR FRAMING (INCLUDING PLYWOOD SUBFLOOR) REQUIRED TO STABILIZE THE WALLS ARE COMPLETED AND

– FOOTINGS DIMENSIONS ARE BASED ON THE SOIL BEARING CAPACITY PROVIDED BY THE GEOTECHNICAL ENGINEER.


#### BASEMENT NOTE:

1.01

- IF A BEDROOM IS ADDED IN THE BASEMENT, THE ROOM MUST CONFORM WITH

1) EXCEPT WHERE A DOOR ON THE SAME FLOOR LEVEL AS THE BEDROOM PROVIDES DIRECT ACCESS TO THE EXTERIOR, EVERY FLOOR LEVEL CONTAINING A BEDROOM IN A SUITE SHALL BE PROVIDED WITH AT LEAST 1 OUTISE WINDOW THAT:

A) IS OPENABLE FROM THE INSIDE WITHOUT THE USE OF TOOLS; AND B) PROVIDES AN INDIVIDUAL UNORSTRUCTED OPEN PORTION HAVING A MINIMUM AREA OF 0,38m2 (3,8 SQ.FT.) WITH NO DIMENSIONS LESS THAN 380mm (15IN)

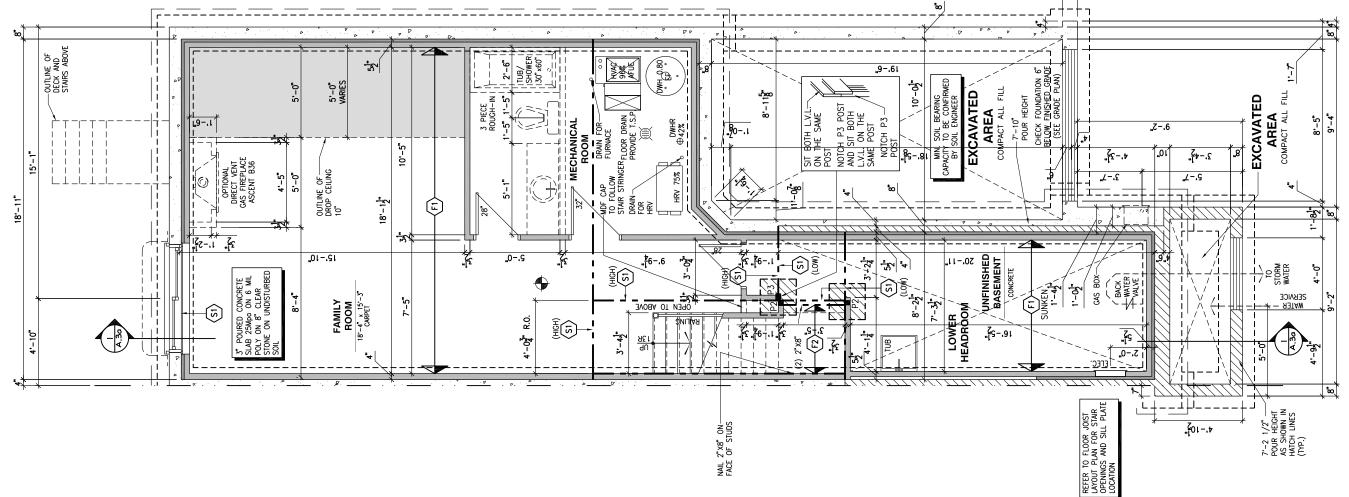

(A.5f

BASEMENT FLOOR PLAN - ENERGY STAR - SPRAY FOAM AND 2x4 FROST WALL - GARAGE END UNIT

SCALE: 3/16" = 1'-0"

LOT: **XXXX** DATE: XX/XX/XXXX



DANIEL GUERIN , ARCHITECTURAL MANAGER FOR
ALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS
ND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

PERSONAL BOIN #19896

TARION REGISTRATION NUMBER #611

S DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE I- IA AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE ETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW LL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS LTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING OCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

## NOTES: STEEL LINTEL: S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10 $S6 = L 200 \times 100 \times 12$

S7 = L 150x100x10 (8" BEARING)

## LINTEL TABLE:

L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES

 $L3 = 2-1.75 \times 9.5$  LVL (1.9E) + P3 ON BOTH SIDES

• IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

#### POST TARLE

P1 = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-224 OR 2-2x6
P3 = 3-2x4 OR 3-2x6

P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)

P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*)

P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 O.D.x4.8 + 100x180x12 BOTTOM PL.

(\*) = 2-120 ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)\* IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
 SHALL HAVE A VISUAL SIGNALING DEVICE;
 ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;
 ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;
 ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING

POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND — CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

### 2012 O.B.C. DRAWINGS

<u> </u>			
REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

## TAWING: BASEMENT FLOOR PLAN **ENERGY STAR - GARAGE END**

3/16" = 1'-0"

120 - THE HUNTLEY 2020 FOOTPRINT

**A.5f** 

XX/XX/XXXX

SHEET

[m]

- 11 1/8" PRE-ENG. OPEN JOIST TRIFORCE @ 19.2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR S1) ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

 $(\sim)$ 

"0-'8

 $\odot$ 

 $\Theta$ 

1.75"×11. .. (1.9E)

(2) 1 L.V.L.

GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE FOUNDATION WALL OR SUPPORTING MEMBER
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS

0

ASCENT B36

DIRECT VENT GAS FIREPLACE

**JANOIT90** 

"G-,t

12,-10,

"501-'e1

3" PO SLAB POLY STONE

7

52

<u>-</u>₽

ţ.

2, 0,,

 $(\Xi)$ 

 $5'-3\frac{1}{2}$ 

2,-0,

WALK-OUT DECK FRAMING NOTES:

- $2^{\prime\prime}\times10^{\prime\prime}$  solid blocking at ledger nailed to Rim Board and top plates, install at the same time as comfort Board and install typek homewrap or equivalent continuous over solid blocking
- 2"x10" PRESSURE TREATED LEDGER. FASTEN TOP THROUGH 2"x10" SOLID BLOCKING AND RIM BOARD, FASTEN BOTTOM THROUGH 2"x10" SOLID BLOCKING AND TOP PLATES WITH 3/8" x 6" LAG SCREWS AND WASHERS @ 16" o/c
- RIM BOARD 2"x10" PRESSURE TREATED TO CANTILEVER POSTS 1 ½" ALL AROUND
- $\langle 4 \rangle$ 2"x10" PRESSURE TREATED JOISTS @ 16" o/c
- $\langle 5 \rangle$ 3-2"x10" PRESSURE TREATED (FLUSH)
- JOIST HANGERS AT EVERY JOIST CONNECTION

A SO A

OWH O

₹

[ [ [ [ [ ] ] ] ] ] ] ] ]

24.-5.

24.-1<del>2</del>7

0/د 12" ING RTIC

12" ● 1 00TIN VER

ORCED WALL AS SHO ATCH LINES: A VERTICAL BARS © 1 HORIZONIAL BARS IN FOG A DOWEL BARS IN FOG HORIZONIAL × 24" V

REINFO IN HAT - 15M - 15M - 15M 10" I

14.-0.

2"x8" 0F S

NAIL FACE

.9-.69

PRA HRV

9.-9 4.

OPEN TO ABOVE

.8.-2<mark>9</mark>..

.9-.61

4 1<del>7.</del>

4'-24

ICH P3 POST
5) SIT BOTH
L. ON THE
IE POST
OTCH P3

<u>-</u>E

SOL

N Z Z

LOWER F

ER WALL FILL S 2" SPRAY (TYP.)

- ALL GARAGE FLOOR SLAB TO BE 4" THICK AND 4650 P.S.I. c/w 5 TO 8% AIR ENTRAINED & TO BE SLOPED TOWARDS THE EXTERIOR (MIN 2% SLOPE);

- CONCRETE FOOTINGS MUST BE PLACED ON UNDISTERBED OR COMPACTED SOIL TO AN ELEVATION BELOW FROST PENETRATION:

- FOUNDATION WALL SHALL NOT BE BACKFILLED UNTIL CONCRETE HAS REACHED ITS SPECIFIED 28 DAYS STRENGHT AND STRUCTURAL FLOOR FRAMING (INCLUDING PLYWOOD SUBFLOOR) REQUIRED TO STABILIZE THE WALLS ARE COMPLETED AND

– FOOTINGS DIMENSIONS ARE BASED ON THE SOIL BEARING CAPACITY PROVIDED BY THE GEOTECHNICAL ENGINEER.

#### BASEMENT NOTE:

SRA SN)

FOUNDATI FINISHED GRADE PI

LOW (SEE

10.

<del>,</del>4

1/2"— HEIGHT IOWN IN LINES

"T – 'Σ

Z.-0<u>..</u>

.4

ELEC.

EXCAVATE AREA COMPACT ALL

UNFINISHE

16'-5<mark>!"</mark>

17.-2]..

- IF A BEDROOM IS ADDED IN THE BASEMENT, THE ROOM MUST CONFORM WITH

1) EXCEPT WHERE A DOOR ON THE SAME FLOOR LEVEL AS THE BEDROOM PROVIDES DIRECT ACCESS TO THE EXTERIOR, EVERY FLOOR LEVEL CONTAINING A BEDROOM IN A SUITE SHALL BE PROVIDED WITH AT LEAST 1 OUTISE WINDOW THAT:

A) IS OPENABLE FROM THE INSIDE WITHOUT THE USE OF TOOLS; AND B) PROVIDES AN INDIVIDUAL, UNOBSTRUCTED OPEN PORTION HAVING A MINIMUM AREA OF 0,38m2 (3,8 SQ.FT.) WITH NO DIMENSIONS LESS THAN 380mm (15IN)

.7-.6

2.-4<u>J.</u>.

3,-4∥.. 4.-10<del>[</del>

"Z – ,G

- ALL CONCRETE TO HAVE A MINIMUM COMPRESSIVE STRENGHT OF 3000 P.S.I. (21MPa) AT 28 DAYS;

Homes (2019) Limited

**XXXX** 

XX/XX/XXXX

DANIEL GUERIN , ARCHITECTURAL MANAGER FOR
ALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS
ND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

PERSONAL BCIN #19896

LOT:

DATE:

- TARION REGISTRATION NUMBER #611
- SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM

-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE ETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW L ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS LTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING OCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

#### NOTES: STEEL LINTEL:

S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x10 S5 = L 125x90x10

S7 = L 150x100x10 (8" BEARING)

### LINTEL TABLE:

ION WALL INVERTED

CHECK FOUNDATIC 7.5" DOWN FOR STEP 8'-5"

SERVICE

<u>-</u>6

→ NATER → +

L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES

L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES  $L4 = 3-1.75 \times 9.5$  LVL (1.9E) + P3 ON BOTH SIDES

• IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

#### POST TABLE:

P1 = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP

P2 = 2-2x4 OR 2-2x6 P3 = 3-2x4 OR 3-2x6

P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)

P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*)

P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL.

(\*) = 2-120 ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)

F NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:

- SHALL HAVE A VISUAL SIGNALING DEVICE;

- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;

- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT,

- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING

POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND - CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

## 2012 O.B.C. DRAWINGS

EXCAVATED - AREA COMPACT ALL FILL	- CAPBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.  = PROVIDE MECHANICAL EXHAUST TO OUTSIDE				
XCAV ARI		2012 O.B.C. DRA	WINGS		
<b>ದ</b> ೮					
	REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON	
	REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH	
	REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH	
	REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD	
	NO.	DESCRIPTION	MM/DD/YYYY	BY	

## RAWING: BASEMENT FLOOR PLAN **WALKOUT - PORCH END UNIT**

3/16" = 1'-0" XX/XX/XXXX

SHEET

**A.**5g

120 - THE HUNTLEY 2020 FOOTPRINT

(STANDARD DRAWINGS)



SCALE: 3/16" = 1'-0"

- 11 1/8" PRE-ENG. OPEN JOIST TRIFORCE @ 19.2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR S1) ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE FOUNDATION WALL OR SUPPORTING MEMBER
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS

WALK-OUT DECK FRAMING NOTES:

- $2^{\prime\prime}\times10^{\prime\prime}$  solid blocking at ledger nailed to Rim Board and top plates. Install at the same time as comfort board and install tyck homewrap or equivalent continuous over solid blocking
- 2"x10" PRESSURE TREATED LEDGER. FASTEN TOP THROUGH 2"x10" SOLID BLOCKING AND RIM BOARD, FASTEN BOTTOM THROUGH 2"x10" SOLID BLOCKING AND TOP PLATES WITH 3/8" x 6" LAG SCREWS AND WASHERS @ 16" o/c
- RIM BOARD 2"x10" PRESSURE TREATED TO CANTILEVER POSTS 1 ½" ALL AROUND
- $\langle 4 \rangle$ 2"x10" PRESSURE TREATED JOISTS @ 16" o/c
- $\langle 5 \rangle$ 3-2"x10" PRESSURE TREATED (FLUSH)
- JOIST HANGERS AT EVERY JOIST CONNECTION

- ALL CONCRETE TO HAVE A MINIMUM COMPRESSIVE STRENGHT OF 3000 P.S.I. (21MPa) AT 28 DAYS;

- ALL GARAGE FLOOR SLAB TO BE 4" THICK AND 4650 P.S.I. c/w 5 TO 8% AIR ENTRAINED & TO BE SLOPED TOWARDS THE EXTERIOR (MIN 2% SLOPE);

- CONCRETE FOOTINGS MUST BE PLACED ON UNDISTERBED OR COMPACTED SOIL TO AN ELEVATION BELOW FROST PENETRATION:

- FOUNDATION WALL SHALL NOT BE BACKFILLED UNTIL CONCRETE HAS REACHED ITS SPECIFIED 28 DAYS STRENGHT AND STRUCTURAL FLOOR FRAMING (INCLUDING PLYWOOD SUBFLOOR) REQUIRED TO STABILIZE THE WALLS ARE COMPLETED AND FULLY NAILED AND ANCHORED:

– FOOTINGS DIMENSIONS ARE BASED ON THE SOIL BEARING CAPACITY PROVIDED BY THE GEOTECHNICAL ENGINEER.

#### BASEMENT NOTE:

- IF A BEDROOM IS ADDED IN THE BASEMENT, THE ROOM MUST CONFORM WITH

1) EXCEPT WHERE A DOOR ON THE SAME FLOOR LEVEL AS THE BEDROOM PROVIDES DIRECT ACCESS TO THE EXTERIOR, EVERY FLOOR LEVEL CONTAINING A BEDROOM IN A SUITE SHALL BE PROVIDED WITH AT LEAST 1 OUTISE WINDOW THAT:

A) IS OPENABLE FROM THE INSIDE WITHOUT THE USE OF TOOLS; AND B) PROVIDES AN INDIVIDUAL UNORSTRUCTED OPEN PORTION HAVING A MINIMUM AREA OF 0,38m2 (3,8 SQ.FT.) WITH NO DIMENSIONS LESS THAN 380mm (15IN)

 $\bigcirc$ 0 H-0.80) .9-.6ı (-)**YZCENI B26** CAS FIREPLACE AREA

WPACT ALL FILL -EXCAVATED
AREA
COMPACT ALL FILL
8'-5 DIRECT VENT SIT BOTH L.V.L.
ON THE SAME
POST
NOTCH P3 POST
AND SIT BOTH
L.V.L. ON THE
SAME POST
POST
POST
POST
MIN SOIL BEARIN
MIN SOIL BEARIN
MIN SOIL ENGINEF PAC.

-7'-10"
POUR H
CHECK F
BELOW F
(SEE  $\bigcirc$ 4,-3]" 3,-4],, 2,-0, Ĭ ..9 7-.5 ......S **₽** 1.75"×11. -- (1.9E) OUTLII DROP 10" (Z) ..0-.8 **₩** WNFINISHED SO-11 CONCRET (0)(m).01-.91 2.-0, .<del>|</del>76−.6 4 (<del>2</del>5 \(\frac{1}{2}\)(\sigma) **ZEBAICE** ОРЕИ ТО АВОУЕ - MATER -(S) E <u>Z</u>ç 10<mark>1</mark> 5،−0. TELEC. JOIST STAIR L PLATE 7'-2 1/2" -POUR HEIGH AS SHOWN HATCH LINES (TYP.) 4.-10<del>]</del>.. FLOOR JC AN FOR S AND SILL

**BASEMENT FLOOR PLAN - WALKOUT - MID UNIT** (A.5h SCALE: 3/16" = 1'-0"

120 - THE HUNTLEY 2020 FOOTPRINT

(STANDARD DRAWINGS)

LOT: **XXXX** XX/XX/XXXX



DANIEL GUERIN , ARCHITECTURAL MANAGER FOR
ALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS
ND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

PERSONAL BCIN #19896

TARION REGISTRATION NUMBER #611

SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM

I-- IA AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE ETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW LL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS LTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING OCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

NOTES	NOTES:			
STEEL	STEEL LINTEL:			
S1 S2 S3 S4 S5 S6 S7	= L 90x90x6 = L 90x90x8 = L 100x90x8 = L 125x90x8 = L 125x90x10 = L 200x100x12 = L 150x100x10 (8" BEARING)			

### LINTEL TABLE:

L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES

L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES

 $L4 = 3-1.75 \times 9.5$  LVL (1.9E) + P3 ON BOTH SIDES

• IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

### POST TABLE:

· w

P1 = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAYY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-224 OR 2-2x6
P3 = 3-2x4 OR 3-2x6

P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)

P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*)

P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL.

(\*) = 2-120 ANCH. (WHERE ANCH. PL. NOT USED)

POST ARE ALL JACK c/w STUD (EX. P2 = 1 JACK + 1 STUD)

F NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

 SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
 SHALL HAVE A VISUAL SIGNALING DEVICE;
 ARE RECOURED IN EACH SIEFPING ROOM AND HALLWAY;
 ARE RECOURED ON EACH STOREY, INCLUDING BASEMENT,
 ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND — CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

## 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

RAWING: BASEMENT FLOOR PLAN **WALKOUT - MID UNIT** 

> 3/16" = 1'-0" XX/XX/XXXX

> > SHEET **A.5h**

- 11 1/8" PRE-ENG. OPEN JOIST TRIFORCE @ 19.2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR S1) ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

#### GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE FOUNDATION WALL OR SUPPORTING MEMBER
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS

### WALK-OUT DECK FRAMING NOTES:

- $2^{\prime\prime}\times10^{\prime\prime}$  solid blocking at ledger nailed to Rim Board and top plates, install at the same time as comfort Board and install typek homewrap or equivalent continuous over solid blocking
- 2"x10" PRESSURE TREATED LEDGER. FASTEN TOP THROUGH 2"x10" SOLID BLOCKING AND RIM BOARD, FASTEN BOTTOM THROUGH 2"x10" SOLID BLOCKING AND TOP PLATES WITH 3/8" x 6" LAG SCREWS AND WASHERS @ 16" o/c
- RIM BOARD 2"x10" PRESSURE TREATED TO CANTILEVER POSTS 1 ½" ALL AROUND
- $\langle 4 \rangle$ 2"x10" PRESSURE TREATED JOISTS @ 16" o/c
- $\langle 5 \rangle$ 3-2"x10" PRESSURE TREATED (FLUSH)
- JOIST HANGERS AT EVERY JOIST CONNECTION

- ALL CONCRETE TO HAVE A MINIMUM COMPRESSIVE STRENGHT OF 3000 P.S.I. (21MPa) AT 28 DAYS;

- ALL GARAGE FLOOR SLAB TO BE 4" THICK AND 4650 P.S.I. c/w 5 TO 8% AIR ENTRAINED & TO BE SLOPED TOWARDS THE EXTERIOR (MIN 2% SLOPE);

- CONCRETE FOOTINGS MUST BE PLACED ON UNDISTERBED OR COMPACTED SOIL TO AN ELEVATION BELOW FROST PENETRATION:

- FOUNDATION WALL SHALL NOT BE BACKFILLED UNTIL CONCRETE HAS REACHED ITS SPECIFIED 28 DAYS STRENGHT AND STRUCTURAL FLOOR FRAMING (INCLUDING PLYWOOD SUBFLOOR) REQUIRED TO STABILIZE THE WALLS ARE COMPLETED AND FULLY NAILED AND ANCHORED:


– FOOTINGS DIMENSIONS ARE BASED ON THE SOIL BEARING CAPACITY PROVIDED BY THE GEOTECHNICAL ENGINEER.

#### BASEMENT NOTE:

- IF A BEDROOM IS ADDED IN THE BASEMENT, THE ROOM MUST CONFORM WITH

1) EXCEPT WHERE A DOOR ON THE SAME FLOOR LEVEL AS THE BEDROOM PROVIDES DIRECT ACCESS TO THE EXTERIOR, EVERY FLOOR LEVEL CONTAINING A BEDROOM IN A SUITE SHALL BE PROVIDED WITH AT LEAST 1 OUTISE WINDOW THAT:

A) IS OPENABLE FROM THE INSIDE WITHOUT THE USE OF TOOLS; AND B) PROVIDES AN INDIVIDUAL UNORSTRUCTED OPEN PORTION HAVING A MINIMUM AREA OF 0,38m2 (3,8 SQ.FT.) WITH NO DIMENSIONS LESS THAN 380mm (15IN)

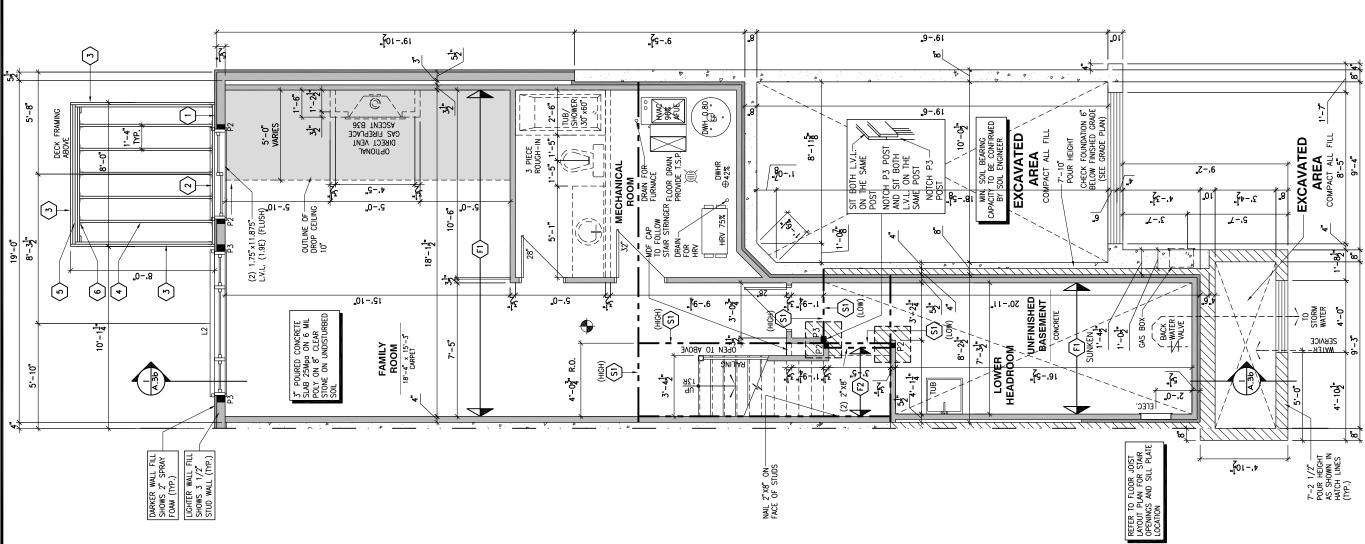

DANIEL GUERIN , ARCHITECTURAL MANAGER FOR
ALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS
ND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES. PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

LOT:

DATE:

SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM

-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE ETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW L ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS LTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT

XXXX

XX/XX/XXXX

Homes (2019) Limited

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

### NOTES: STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10
- $S6 = L 200 \times 100 \times 12$
- S7 = L 150x100x10 (8" BEARING)

#### LINTEL TABLE:

- L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES
- L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES  $L4 = 3-1.75 \times 9.5$  LVL (1.9E) + P3 ON BOTH SIDES

IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

#### POST TABLE:

P1 = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP

- P2 = 2-2x4 OR 2-2x6 P3 = 3-2x4 OR 3-2x6

- P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)
- P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*)
- P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL.
- (\*) = 2-120 ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)F NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

SMOKE ALARMS AS PER SECTION 9.10.19. OF THE
ONTARIO BUILDING CODE:

- SHALL HAVE A VISUAL SIGNALING DEVICE;

- ARE REQUIRED IN EACH SIEEPING ROOM AND HALLWAY;

- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT,

- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN
ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND — CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

### 2012 O.B.C. DRAWINGS

+				
	REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
	REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
	REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
	REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
	NO.	DESCRIPTION	MM/DD/YYYY	BY

## RAWING: BASEMENT FLOOR PLAN **WALKOUT - GARAGE END UNIT**

3/16" = 1'-0" XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT


(STANDARD DRAWINGS)

SHEET **A.5i** 

**BASEMENT FLOOR PLAN - WALKOUT - GARAGE END UNIT** 

A.5i

SCALE: 3/16" = 1'-0"

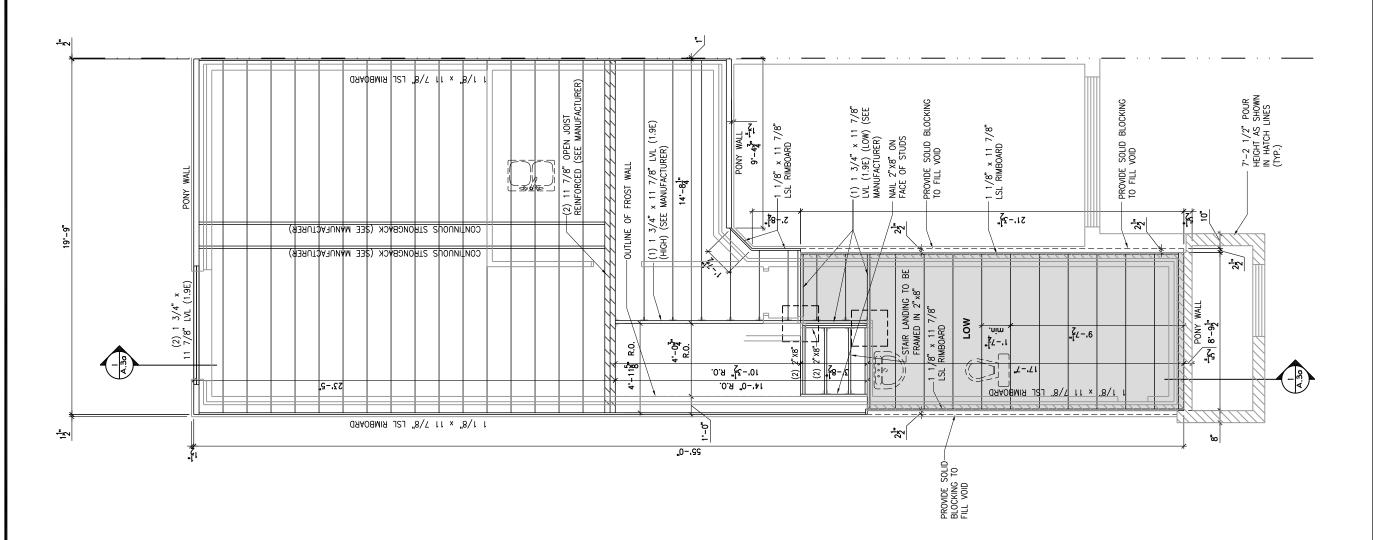

(A.6a)

GROUND FLOOR - FLOOR JOIST FRAMING PLAN - STANDARD KITCHEN - PORCH END UNIT

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>DANIEL GUERIN</u> ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

•• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY 5HOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.C. DRAWINGS

l			
REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	RY


RAWING: GROUND FLOOR - FLOOR **JOIST FRAMING - PORCH END** 

| SCALE: | 3/16" = 1'-0" DATE: XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT

(STANDARD DRAWINGS)

SHEET: A.6a

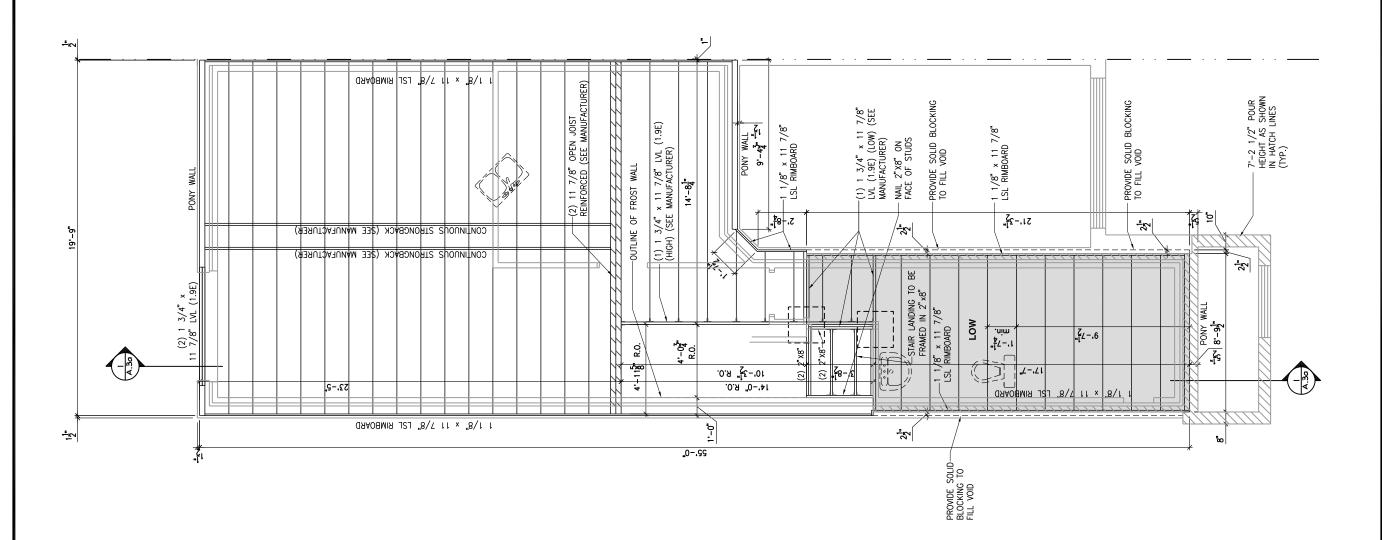

(A.6b)

GROUND FLOOR - FLOOR JOIST FRAMING PLAN - OPTIONAL KITCHEN 1 - PORCH END UNIT

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>DANIEL GUERIN</u> ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

•• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY 5HOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.C. DRAWINGS


REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VΗ
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

RAWING: GROUND FLOOR - FLOOR **JOIST FRAMING - PORCH END** 

DATE: XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT

SHEET: A.6b

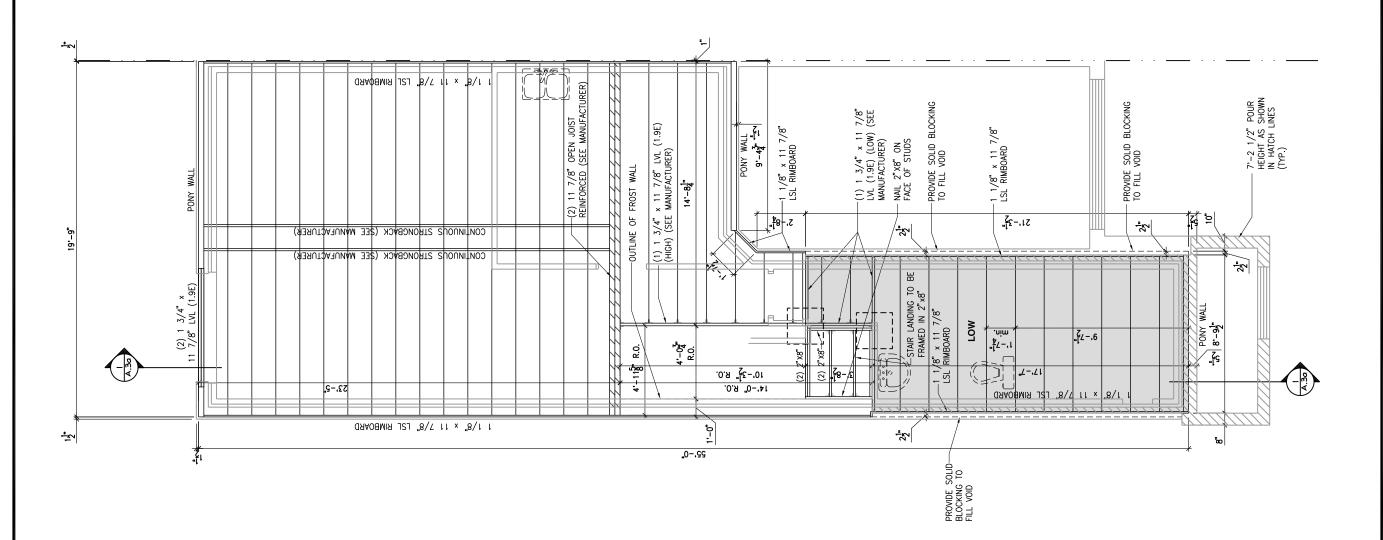

(A.6c)

SCALE: 3/16" = 1'-0"

GROUND FLOOR - FLOOR JOIST FRAMING PLAN - OPTIONAL KITCHEN 2 - PORCH END UNIT

2020 FOOTPRINT

LOT: XXXX DATE: XX/XX/XXXX



I<u>DANIEL GUERIN</u> ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

•• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY 5HOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION		MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY


RAWING: GROUND FLOOR - FLOOR **JOIST FRAMING - PORCH END** 

| SCALE: | 3/16" = 1'-0" DATE: XX/XX/XXXX

120 - THE HUNTLEY

(STANDARD DRAWINGS)

SHEET: A.6c

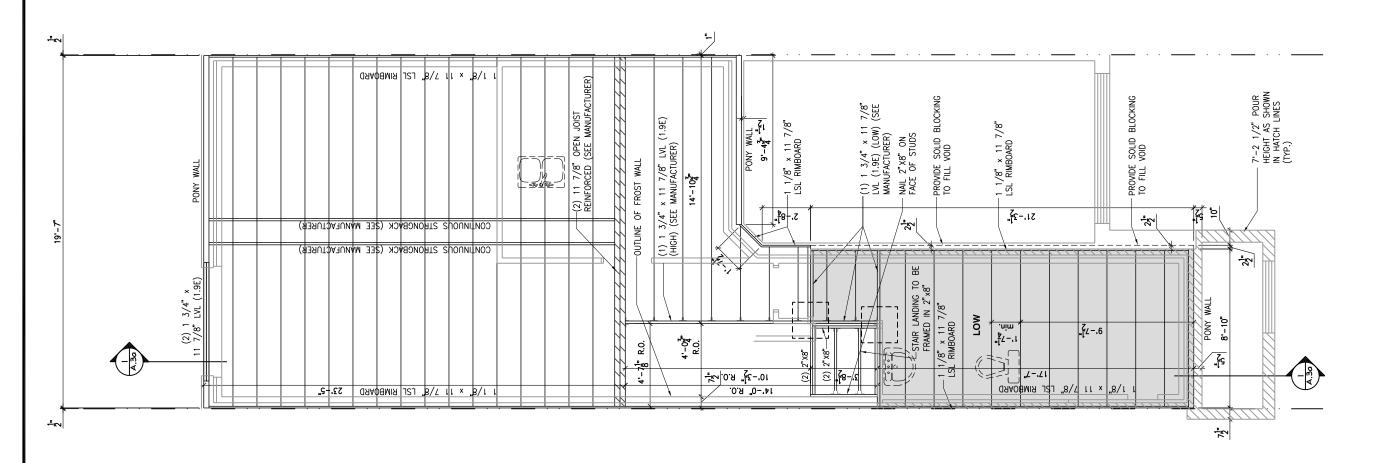

(A.6d)

**GROUND FLOOR - FLOOR JOIST FRAMING PLAN - STANDARD KITCHEN - MID UNIT** 

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>DANIEL GUERIN</u> ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

•• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY 5HOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NΟ	DESCRIPTION	MM/DD/YYYY	RY

RAWING: GROUND FLOOR - FLOOR **JOIST FRAMING PLAN - MID** 


| SCALE: | 3/16" = 1'-0" DATE: XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT

(STANDARD DRAWINGS)

A.6d

SHEET:

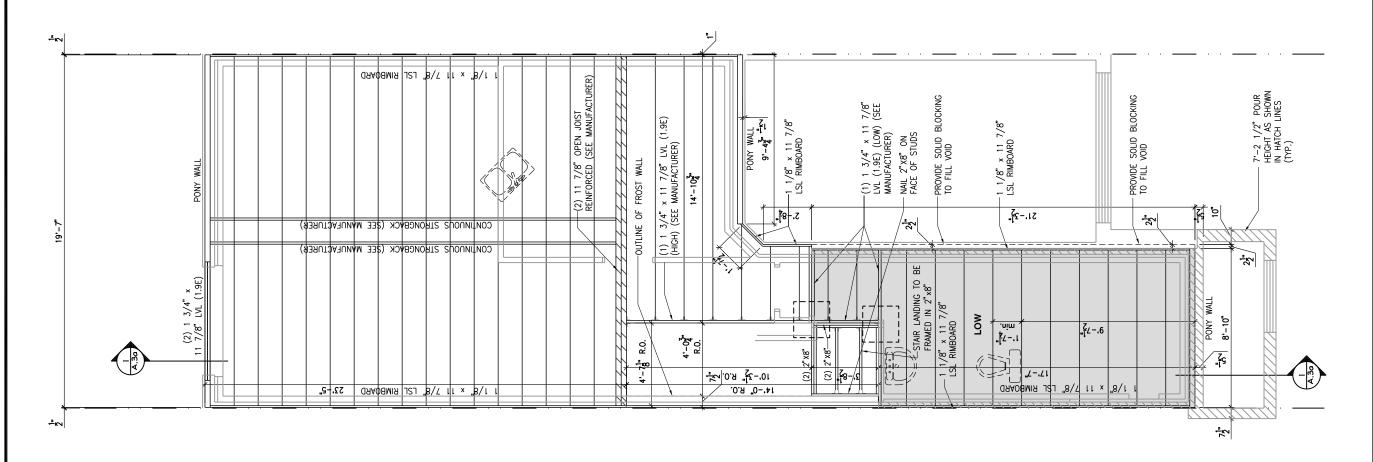

(A.6e)

SCALE: 3/16" = 1'-0"

**GROUND FLOOR - FLOOR JOIST FRAMING PLAN - OPTIONAL KITCHEN 1 - MID UNIT** 

LOT: XXXX DATE: XX/XX/XXXX



I<u>DANIEL GUERIN</u> ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

•• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY 5HOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VΗ
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VΗ
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

RAWING: GROUND FLOOR - FLOOR **JOIST FRAMING PLAN - MID** 

| SCALE: | 3/16" = 1'-0" DATE: XX/XX/XXXX


120 - THE HUNTLEY

2020 FOOTPRINT

(STANDARD DRAWINGS)

A.6e

SHEET:

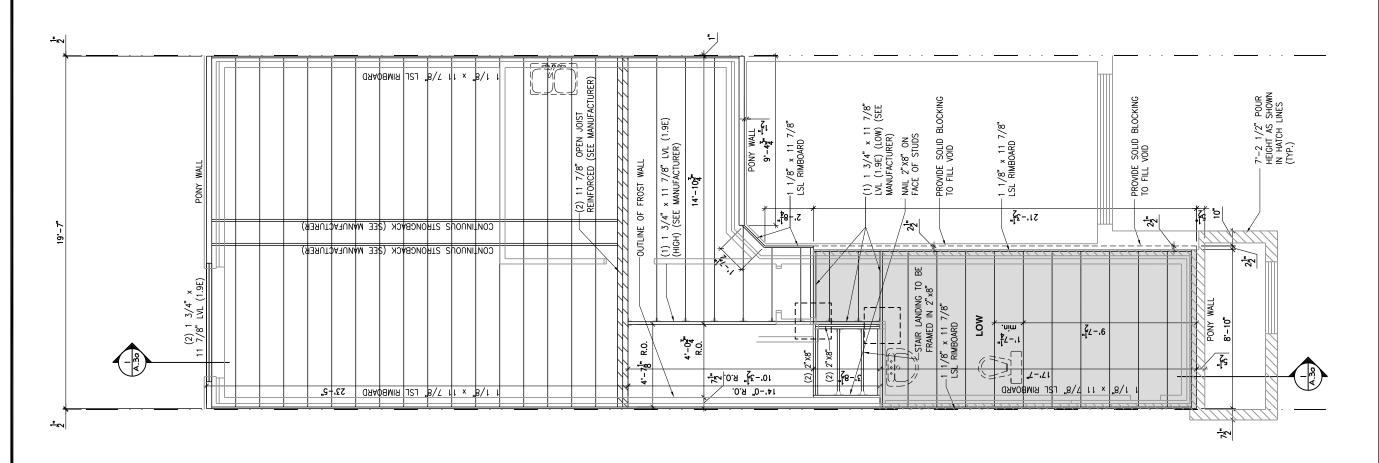

**GROUND FLOOR - FLOOR JOIST FRAMING PLAN - OPTIONAL KITCHEN 2 - MID UNIT** 

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>DANIEL GUERIN</u> ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

•• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY 5HOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.C. DRAWINGS

l			
REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

RAWING: GROUND FLOOR - FLOOR **JOIST FRAMING PLAN - MID** 

| SCALE: | 3/16" = 1'-0"


120 - THE HUNTLEY

2020 FOOTPRINT

DATE: XX/XX/XXXX

SHEET:

A.6f

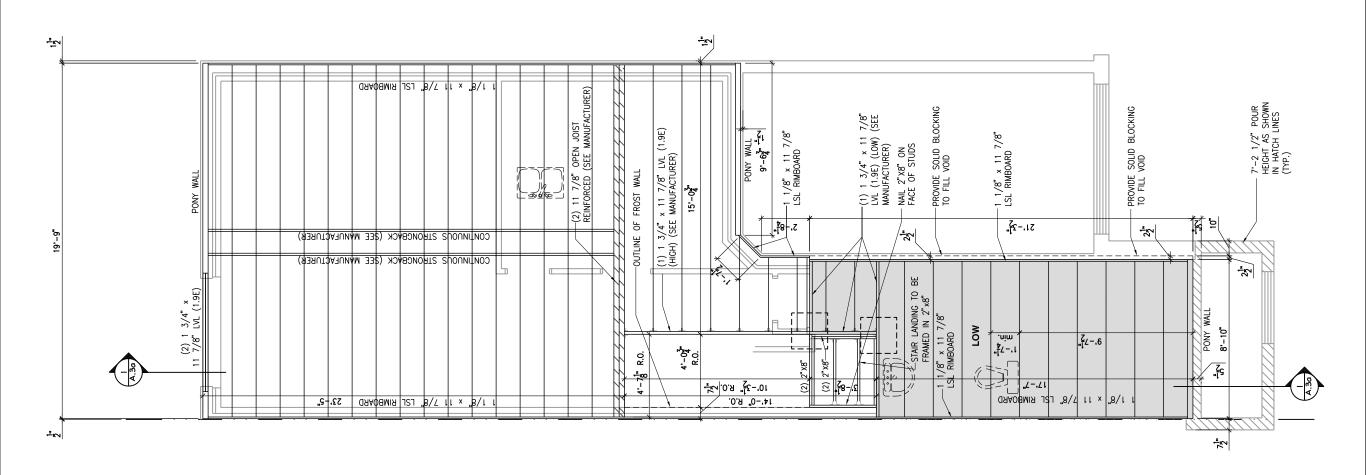

**GROUND FLOOR - FLOOR JOIST FRAMING PLAN - STANDARD KITCHEN - GARAGE END UNIT** 

(A.6g) SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>DANIEL GUERIN</u> ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

•• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY 5HOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.C. DRAWING	S
---------------------	---

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VΗ
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

RAWING: GROUND FLOOR - FLOOR **JOIST FRAMING - GARAGE END** 

| SCALE: | 3/16" = 1'-0"


120 - THE HUNTLEY

2020 FOOTPRINT (STANDARD DRAWINGS)

A.6g

DATE: XX/XX/XXXX

SHEET:

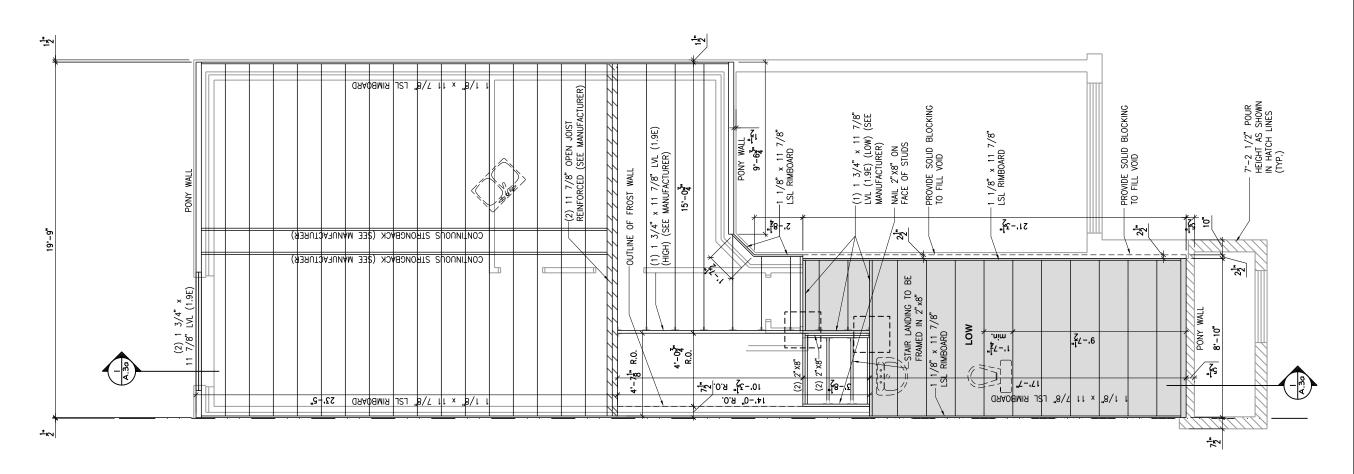

**GROUND FLOOR - FLOOR JOIST FRAMING PLAN - OPTIONAL KITCHEN 1 - GARAGE END UNIT** 

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

•• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY 5HOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.	C. DRAWINGS
-----------	-------------

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VΗ
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

RAWING: GROUND FLOOR - FLOOR **JOIST FRAMING - PORCH END** 


| SCALE: | 3/16" = 1'-0" DATE: XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT

(STANDARD DRAWINGS)

A.6h

SHEET:

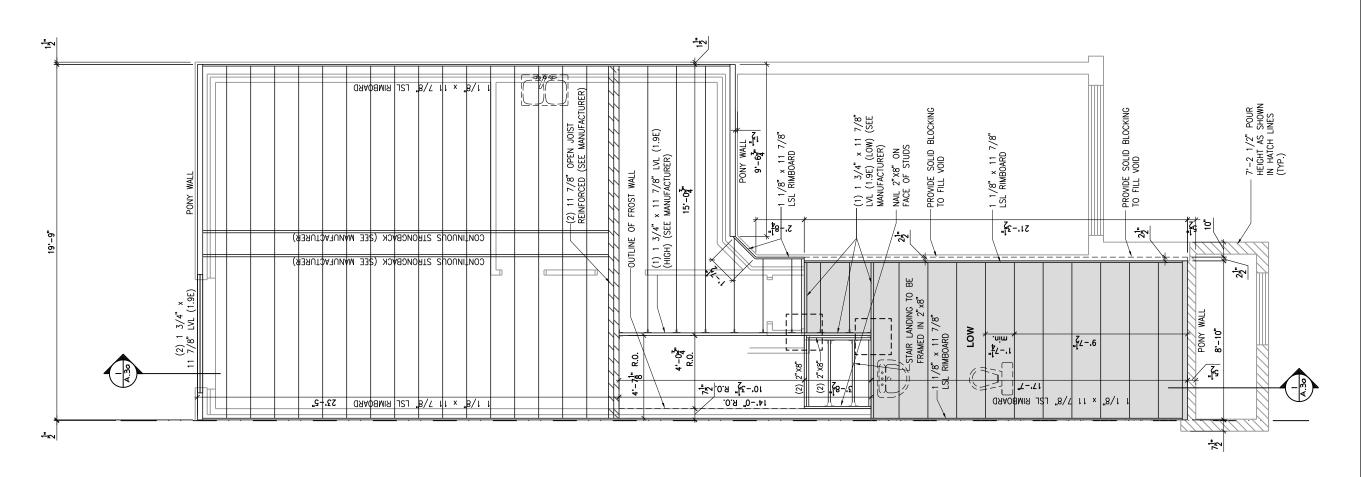

GROUND FLOOR - FLOOR JOIST FRAMING PLAN - OPTIONAL KITCHEN 2 - GARAGE END UNIT

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>DANIEL GUERIN</u> ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

•• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY 5HOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

RAWING: GROUND FLOOR - FLOOR **JOIST FRAMING - GARAGE END** 


| SCALE: | 3/16" = 1'-0" DATE: XX/XX/XXXX

SHEET:

A.6i

120 - THE HUNTLEY 2020 FOOTPRINT

 $2^{\prime\prime}\times10^{\prime\prime}$  solid blocking at ledger nailed to Rim Board and top plates, install at the same time as comfort Board and install tyck homewap or equivalent continuous over solid blocking

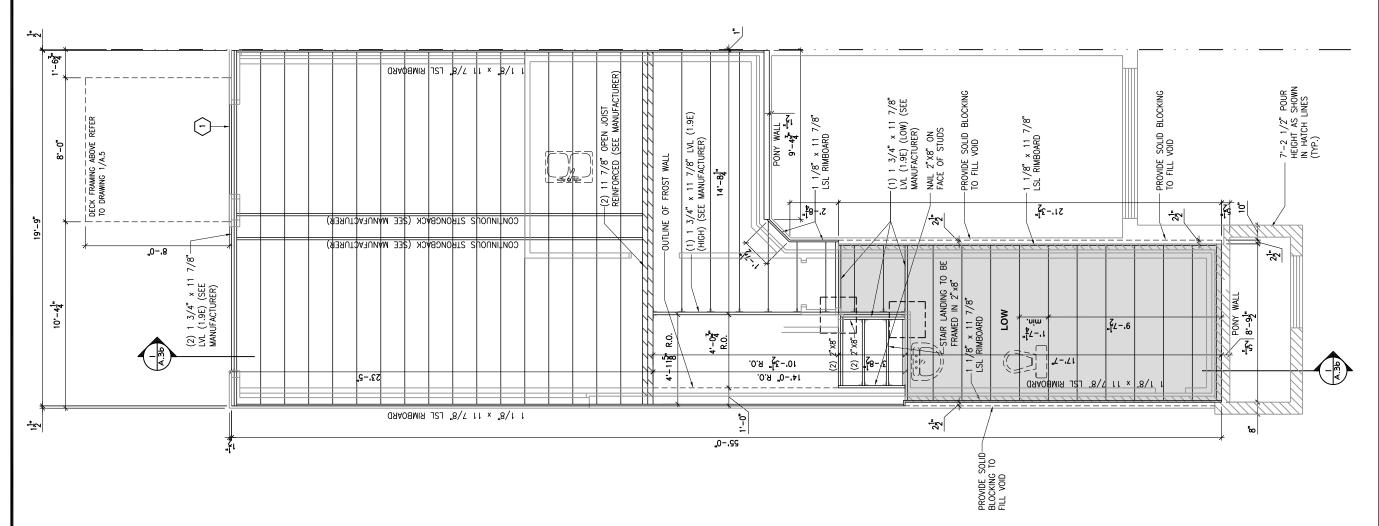

LOT: XXXX DATE: XX/XX/XXXX

Valecraft Homes (2019) Limited

I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

\*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOCETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

PRAWING: GROUND FLOOR - JOIST

xx/xx/xxxx

A.6j

SHEET

FRAMING-WALKOUT-PORCH END


SCALE: 3/16" = 1'-0"

120 - THE HUNTLEY

2020 FOOTPRINT (STANDARD DRAWINGS)

(A.6j/

GROUND FLOOR - FLOOR JOIST FRAMING PLAN - WALKOUT - STANDARD KITCHEN - PORCH END UNIT

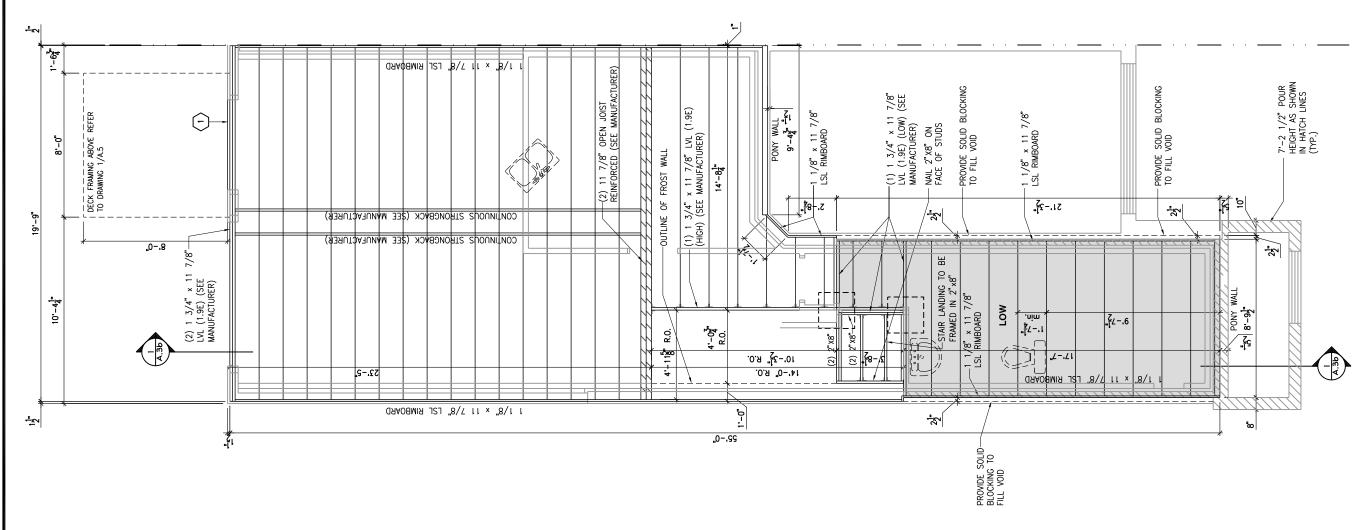

LOT: XXXX DATE: XX/XX/XXXX

Valecraft Homes (2019) Limited

I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYO
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VΗ
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

PRAWING: GROUND FLOOR - JOIST FRAMING-WALKOUT-PORCH END


120 - THE HUNTLEY 2020 FOOTPRINT

(STANDARD DRAWINGS)

SHEET: A.6k

xx/xx/xxxx

GROUND FLOOR - FLOOR JOIST FRAMING PLAN - WALKOUT - OPTIONAL KITCHEN 1 - PORCH END UNIT

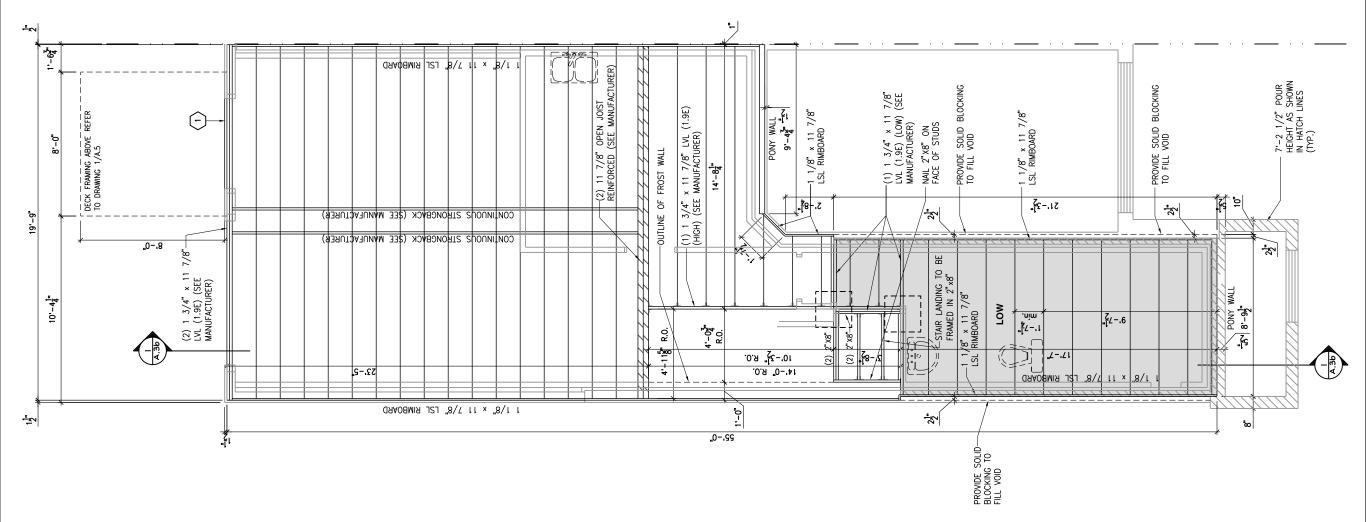

LOT: XXXX DATE: XX/XX/XXXX

Valecraft Homes (2019) Limited

I, <u>Daniel Guerin</u>, architectural manager for valecraft homes Ltd., have reviewed the following documents and take responsibility for the design activities.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

\*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VΗ
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

PRAWING: GROUND FLOOR - JOIST FRAMING-WALKOUT-PORCH END


SHEET

**A.6**I

| SCALE: | 3/16" = 1'-0" DATE: XX/XX/XXXX

120 - THE HUNTLEY

2020 FOOTPRINT (STANDARD DRAWINGS)

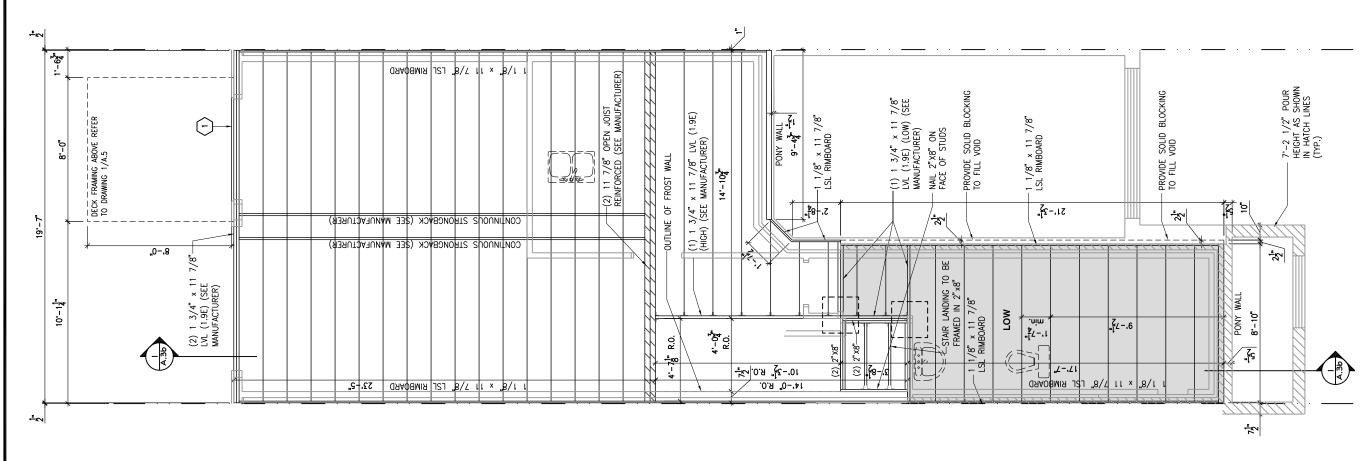

LOT: XXXX DATE: XX/XX/XXXX

Valecraft Homes (2019) Limited

I<u>DANIEL GUERIN</u> ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611
- •• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

PRAWING: GROUND FLOOR - JOIST

xx/xx/xxxx

SHEET:

FRAMING PLAN - WALKOUT - MID

120 - THE HUNTLEY


(STANDARD DRAWINGS)

2020 FOOTPRINT |A.6m|

**GROUND FLOOR - FLOOR JOIST FRAMING PLAN - WALKOUT - STANDARD KITCHEN - MID UNIT** 

(A.6m)

SCALE: 3/16" = 1'-0"

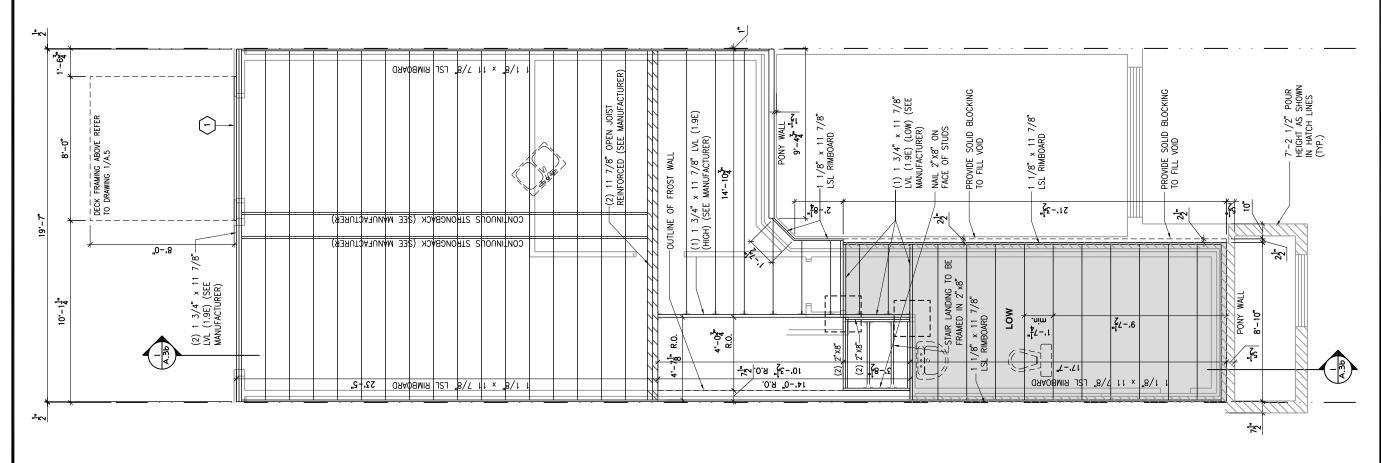

LOT: XXXX DATE: XX/XX/XXXX



I<u>DANIEL GUERIN</u> ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611
- •• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYO
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION		MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

PRAWING: GROUND FLOOR - JOIST

FRAMING PLAN - WALKOUT - MID

xx/xx/xxxx

120 - THE HUNTLEY 2020 FOOTPRINT

SHEET A.6n (STANDARD DRAWINGS)

GROUND FLOOR - FLOOR JOIST FRAMING PLAN - WALKOUT - OPTIONAL KITCHEN 1 - MID UNIT

(A.6n)

SCALE: 3/16" = 1'-0"

LOT:

DATE:

DOCUMENT

XXXX

XX/XX/XXXX


Homes (2019) Limited

I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

\*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

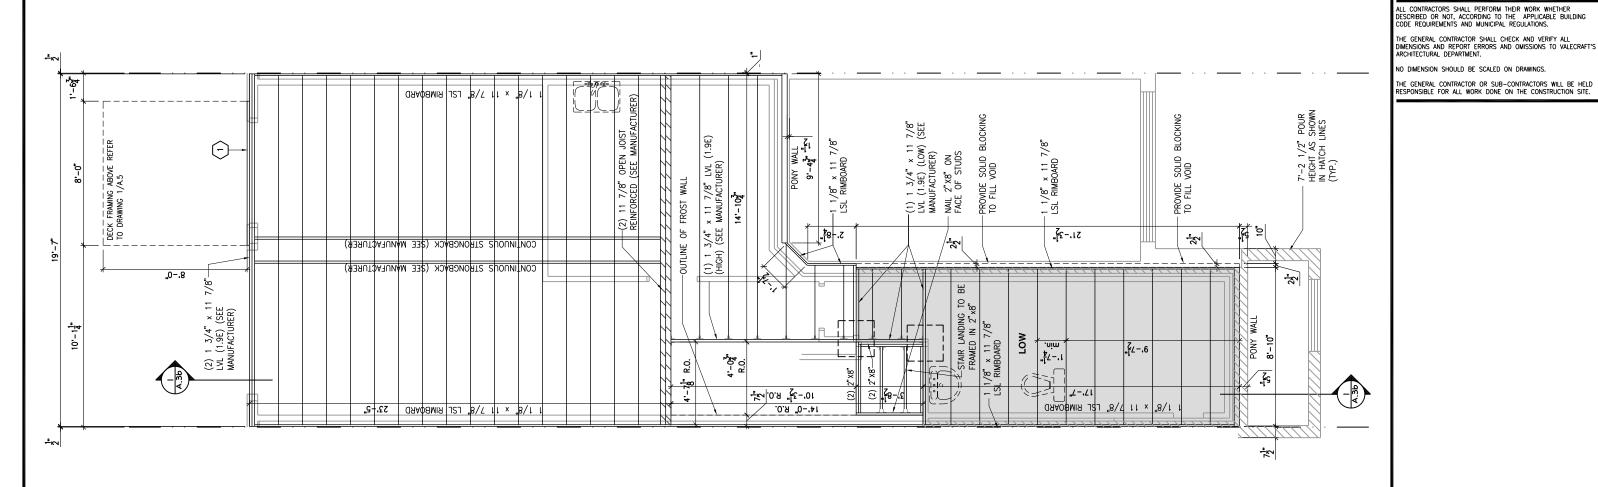

FRAMING PLAN - WALKOUT - MID | SCALE: | 3/16" = 1'-0" xx/xx/xxxx SHEET:

2012 O.B.C. DRAWINGS

REV-4 NEW STANDARD DRWG MODIFICATION 01/01/2021 DOYON

REV-1 NEW STANDARD DRWG MODIFICATION 11/13/2017 MAD
NO. DESCRIPTION MM/DD/YYYY BY DRAWING: GROUND FLOOR - JOIST

120 - THE HUNTLEY 2020 FOOTPRINT

REV-3 AS PER STRUCTURAL REVIEW


REV-2 AS PER STRUCTURAL REVIEW

(STANDARD DRAWINGS)

A.60

03/20/2019 VH 11/07/2018 VH

**GROUND FLOOR - FLOOR JOIST FRAMING PLAN - WALKOUT - OPTIONAL KITCHEN 2 - MID UNIT** 

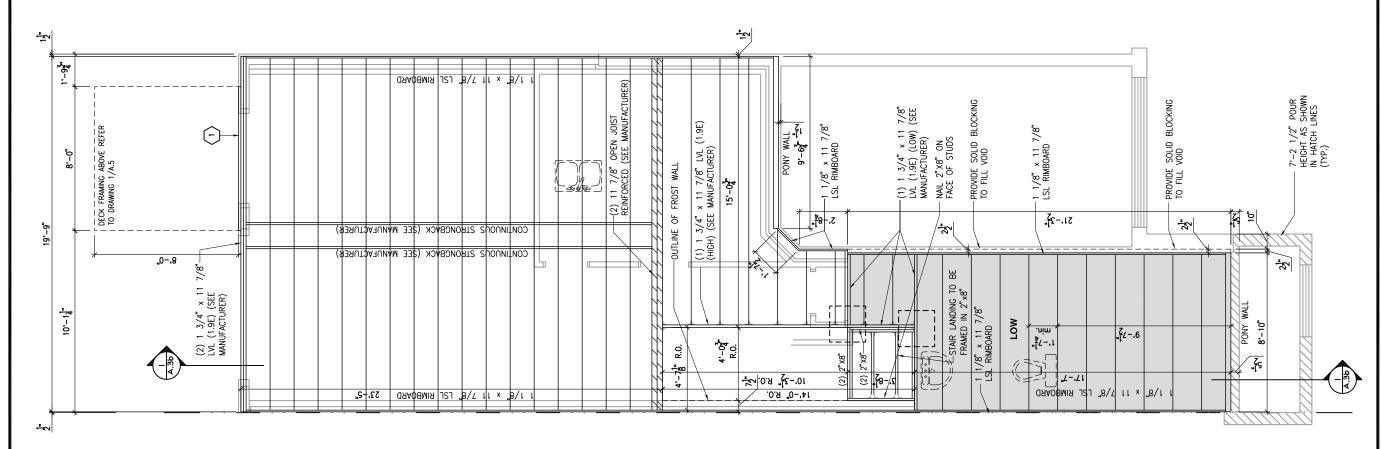

LOT: XXXX DATE: XX/XX/XXXX

Valecraft Homes (2019) Limited

I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611
- •• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYC
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VΗ
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

RAWING: GROUND FLOOR - JOIST

FRAMING-WALKOUT-GARAGE END


| SCALE: | 3/16" = 1'-0" xx/xx/xxxx

120 - THE HUNTLEY 2020 FOOTPRINT

(STANDARD DRAWINGS)

SHEET: A.6p

GROUND FLOOR - FLOOR JOIST FRAMING PLAN - WALKOUT - STANDARD KITCHEN - GARAGE END UNIT

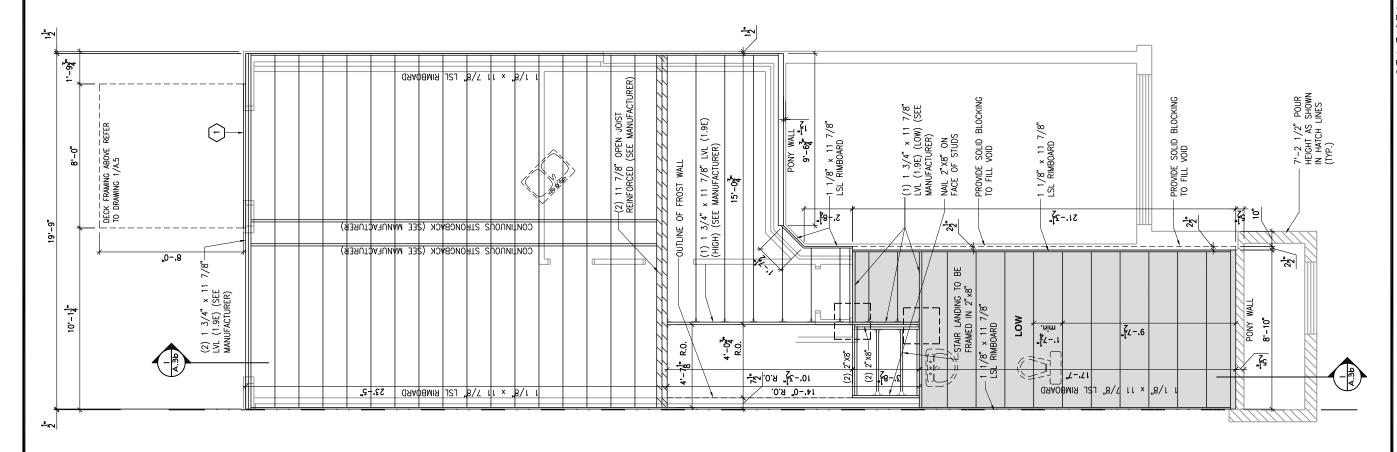

GROUND FLOOR - FLOOR JOIST FRAMING PLAN - WALKOUT - OPTIONAL KITCHEN 1 - GARAGE END UNIT

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611
- •• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VΗ
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

PRAWING: GROUND FLOOR - JOIST


SHEET:

A.6q

FRAMING-WALKOUT-GARAGE END

| SCALE: 3/16" = 1'-0" xx/xx/xxxx

120 - THE HUNTLEY 2020 FOOTPRINT

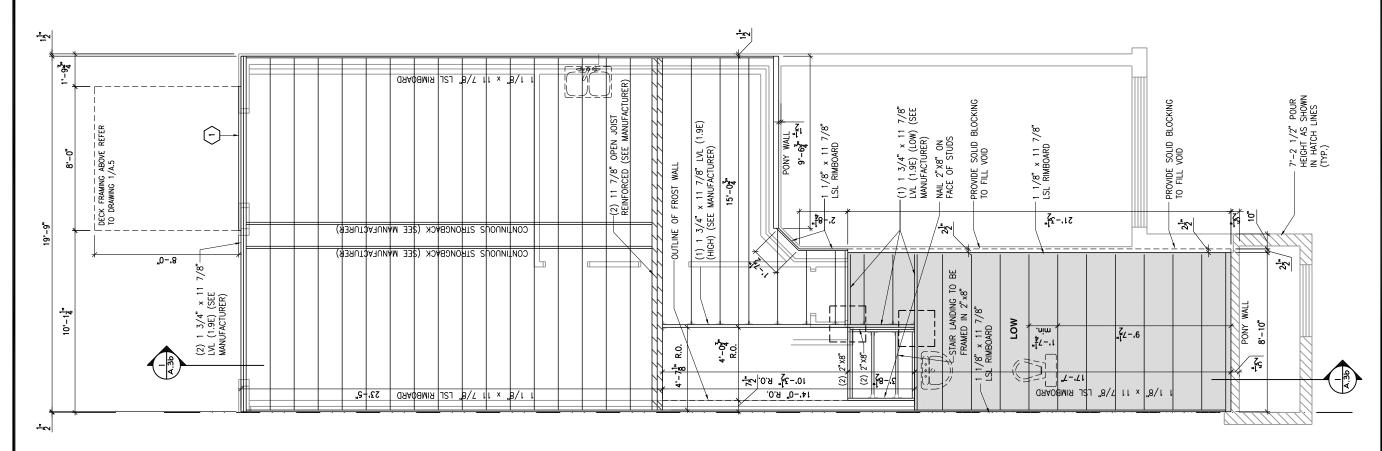

LOT: XXXX DATE: XX/XX/XXXX

Valecraft Homes (2019) Limited

I<u>DANIEL GUERIN</u> ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611
- •• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYO
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VΗ
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VΗ
REV-1	NEW STANDARD DRWG MODIFICATION		MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

PRAWING: GROUND FLOOR - JOIST

FRAMING-WALKOUT-GARAGE END

A.6r

| SCALE: | 3/16" = 1'-0" xx/xx/xxxx SHEET:

120 - THE HUNTLEY

2020 FOOTPRINT

(A.6r

GROUND FLOOR - FLOOR JOIST FRAMING PLAN - WALKOUT - OPTIONAL KITCHEN 2 - GARAGE END UNIT SCALE: 3/16" = 1'-0"


- 11 1/8" PRE-ENG. OPEN JOIST TRIFORCE @ 19.2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE MANUFACTURER)
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS

PORCH CONSTRUCTION: TOP OF CONCRETE TO SLOPE 1" AWAY FROM HOUSE 8" SLOPED TO 7" POURED CONCRETE 32 Mpg 10M
BARS @ 8" o/c EACH WAY PLUS 10M DOWELS 16" o/c
WALL TO SLAB ON CLEAR STONE ON UNDSTURBED
SOIL. SLAB TO BEAR ON FOUNDATION WALLS.

PROVIDE A 10 1/2" x 3/8" STEEL PLATE (5 1/2" OVERHANG PASS EXTERIOR STUD FACE) WITH FULL 1/4" FILLET WELD TO FLANGE AT TOP AND 1" STITCH WELD AT 6" SPACING AT BOTTOM OF FLANGE. (STOP STEEL PLATE 6" SHORT AT BOTH ENDS OF BEAM TO ALLOW BEAM TO SIT ON TOP OF WALL)

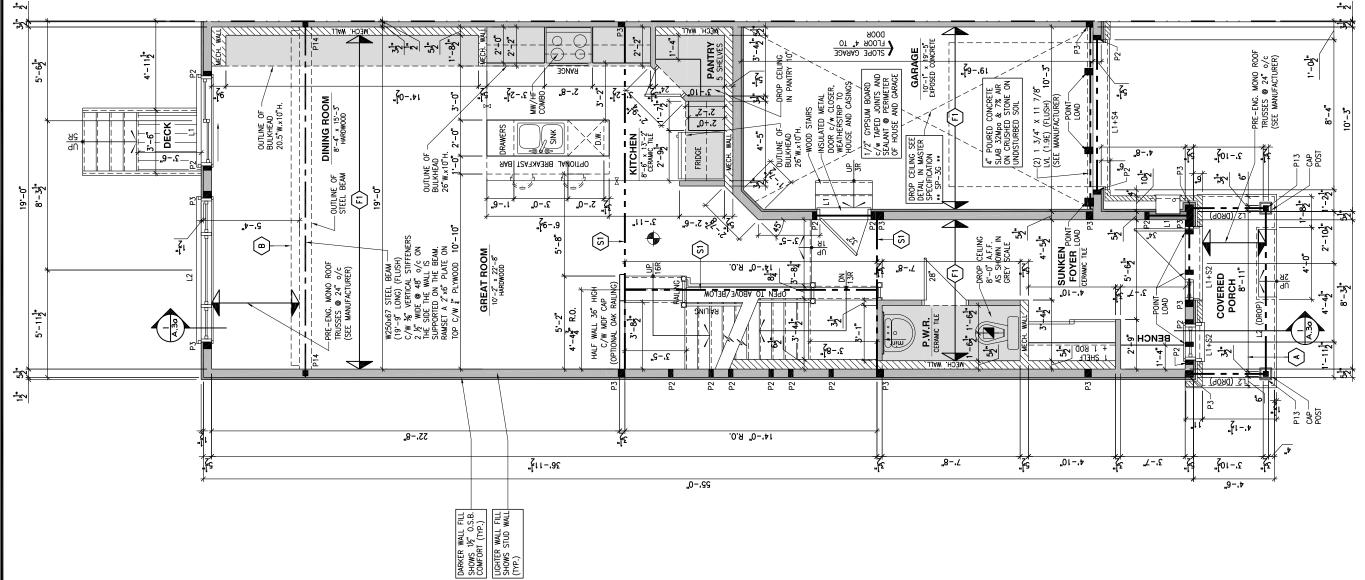

**GROUND FLOOR PLAN - STANDARD KITCHEN - PORCH END UNIT** 

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896
- TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

## STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10
- $S6 = L 200 \times 100 \times 12$
- S7 = L 150x100x10 (8" BEARING)

#### LINTEL TABLE:

- L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES
- L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES L4 = 3-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES
- IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

#### POST TARLE

P1 = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-244 OR 2-2x6
P3 = 3-2x4 OR 3-2x6
P4 = 4-2x4 OR 4-2x6
P5 = 5-2x4 OR 5-2x6
P6 = 6-2x4 OR 6-2x6
P13 = HSS R8 0x88 0x 18 x 100x200x12 T&B P1

P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)

P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*) P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL.

+ 130×160×10 TOP PL. (\*) (\*) = 2-12Ø ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)

• IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

= SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
- SHALL HAVE A VISUAL SIGNALING DEVICE;
- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;
- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;
- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING

POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND — CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

## 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

PRAWING: GROUND FLOOR PLAN

STANDARD KITCHEN - PORCH END

3/16" = 1'-0"

120 - THE HUNTLEY 2020 FOOTPRINT


SHEET **A.7**a

XX/XX/XXXX

- > 11 %" PRE-ENG. OPEN JOIST TRIFORCE @ 19.2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE MANUFACTURER)
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

#### GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS
- PORCH CONSTRUCTION: TOP OF CONCRETE TO SLOPE 1" AWAY FROM HOUSE 8" SLOPED TO 7" POURED CONCRETE 32 Mpg 10M
  BARS @ 8" o/c EACH WAY PLUS 10M DOWELS 16" o/c
  WALL TO SLAB ON CLEAR STONE ON UNDSTURBED
  SOIL. SLAB TO BEAR ON FOUNDATION WALLS.
- PROVIDE A 10 1/2" x 3/8" STEEL PLATE (5 1/2" OVERHANG PASS EXTERIOR STUD FACE) WITH FULL 1/4" FILLET WELD TO FLANGE AT TOP AND 1" STITCH WELD AT 6" SPACING AT BOTTOM OF FLANGE. (STOP STEEL PLATE 6" SHORT AT BOTH ENDS OF BEAM TO ALLOW BEAM TO SIT ON TOP OF WALL)

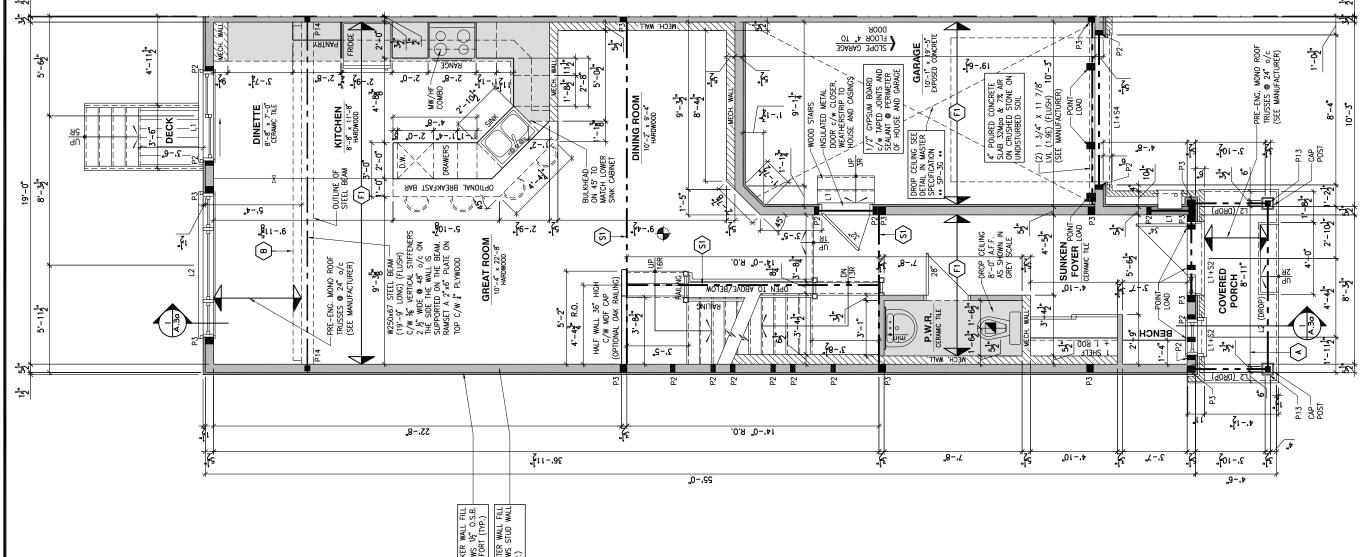

GROUND FLOOR PLAN - OPTIONAL KITCHEN #1 - PORCH END UNIT

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896
- TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

## STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10
- $S6 = L 200 \times 100 \times 12$ S7 = L 150x100x10 (8" BEARING)

#### LINTEL TABLE:

- L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES
- L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES L4 = 3-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES
- IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE

#### POST TABLE:

P1 = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-244 OR 2-2x6
P3 = 3-2x4 OR 3-2x6
P4 = 4-2x4 OR 4-2x6
P5 = 5-2x4 OR 5-2x6
P6 = 6-2x4 OR 6-2x6
P13 = HSS R8 0x88 0x 18 x 100x200x12 T&B P1

- P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)
- P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*) P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL.
- + 130×160×10 TOP PL. (\*) (\*) = 2-12Ø ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)

• IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

= SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
- SHALL HAVE A VISUAL SIGNALING DEVICE;
- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;
- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;
- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND — CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

## 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VΗ
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

## RAWING: GROUND FLOOR PLAN OPT. KITCHEN #1 - PORCH END

3/16" = 1'-0"

XX/XX/XXXX SHEET

120 - THE HUNTLEY 2020 FOOTPRINT

(STANDARD DRAWINGS)

A.7b


- > 11 %" PRE-ENG. OPEN JOIST TRIFORCE @ 19:2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE MANUFACTURER)
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS

PORCH CONSTRUCTION: TOP OF CONCRETE TO SLOPE 1" AWAY FROM HOUSE 8" SLOPED TO 7" POURED CONCRETE 32 Mpg 10M
BARS @ 8" o/c EACH WAY PLUS 10M DOWELS 16" o/c
WALL TO SLAB ON CLEAR STONE ON UNDSTURBED
SOIL. SLAB TO BEAR ON FOUNDATION WALLS.

PROVIDE A 10 1/2" x 3/8" STEEL PLATE (5 1/2" OVERHANG PASS EXTERIOR STUD FACE) WITH FULL 1/4" FILLET WELD TO FLANGE AT TOP AND 1" STITCH WELD AT 6" SPACING AT BOTTOM OF FLANGE. (STOP STEEL PLATE 6" SHORT AT BOTH ENDS OF BEAM TO ALLOW BEAM TO SIT ON TOP OF WALL)

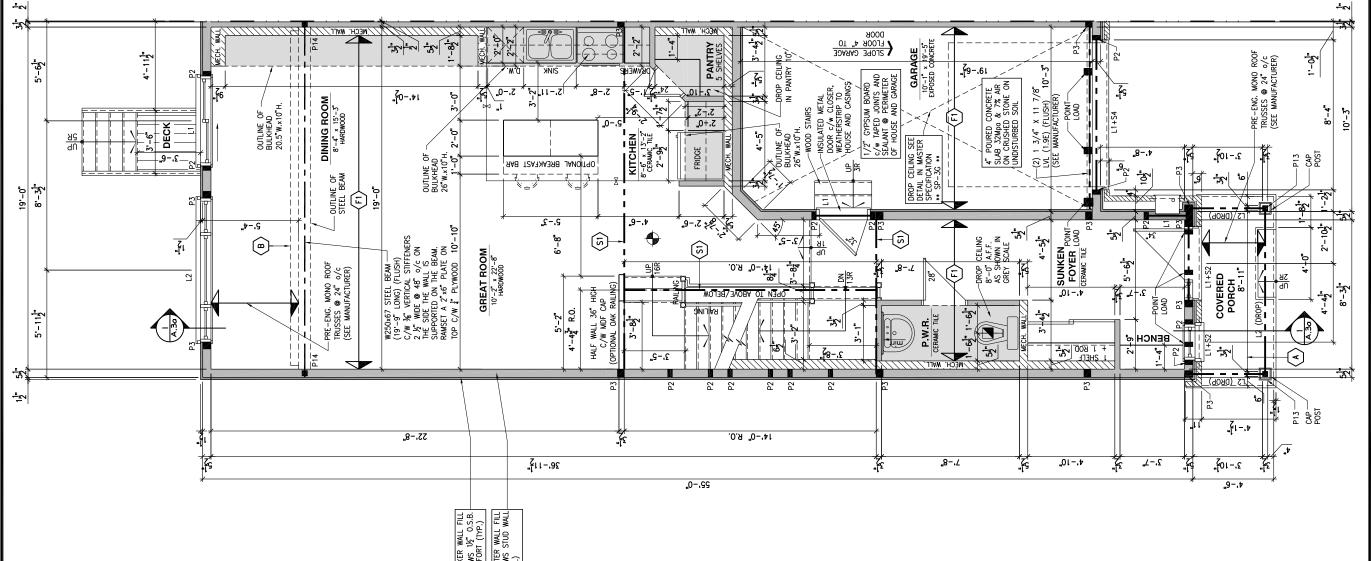

GROUND FLOOR PLAN - OPTIONAL KITCHEN #2 - PORCH END UNIT

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896
- TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

## STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10
- $S6 = L 200 \times 100 \times 12$
- S7 = L 150x100x10 (8" BEARING)

#### LINTEL TABLE:

- L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES
- L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES
- IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

#### POST TABLE:

- P1 = 3" ADJUSTABLE STEEL COLUMN
  P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
  POST BY USP
  P2 = 2-244 OR 2-2x6
  P3 = 3-2x4 OR 3-2x6
  P4 = 4-2x4 OR 4-2x6
  P5 = 5-2x4 OR 5-2x6
  P6 = 6-2x4 OR 6-2x6
  P13 = HSS R8 0x88 0x 18 x 100x200x12 T&B P1
- P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)

- P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*) P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL. + 130×160×10 TOP PL. (\*) (\*) = 2-12Ø ANCH. (WHERE ANCH. PL. NOT USED)
- \* POST ARE ALL JACK c/w STUD
- (EX. P2 = 1 JACK + 1 STUD)

   IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

= SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
- SHALL HAVE A VISUAL SIGNALING DEVICE;
- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;
- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;
- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING

POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND — CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

## 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

## RAWING: GROUND FLOOR PLAN OPT. KITCHEN #2 - PORCH END

(STANDARD DRAWINGS)

3/16" = 1'-0" XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT


A.7c

SHEET

- 11 1/8" PRE-ENG. OPEN JOIST TRIFORCE @ 19.2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE MANUFACTURER)
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

#### GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE FOUNDATION WALL OR SUPPORTING MEMBER
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS
- PORCH CONSTRUCTION: TOP OF CONCRETE TO SLOPE 1" AWAY FROM HOUSE 8" SLOPED TO 7" POURED CONCRETE 32 Mpg 10M BARS @ 8" o/c EACH WAY PLUS 10M DOWELS 16" o/c WALL TO SLAB ON CLEAR STONE ON UNDISTURBED SOLL. SLAB TO BEAR ON FOUNDATION WALLS.
- PROVIDE A 10 1/2" x 3/8" STEEL PLATE (5 1/2" OVERHANG PASS EXTERIOR STUD FACE) WITH FULL 1/4" FILLET WELD TO FLANGE AT TOP AND 1" STITCH WELD AT 6" SPACING AT BOTTOM OF FLANGE. (STOP STEEL PLATE 6" SHORT AT BOTH ENDS OF BEAM TO ALLOW BEAM TO SIT ON TOP OF WALL)

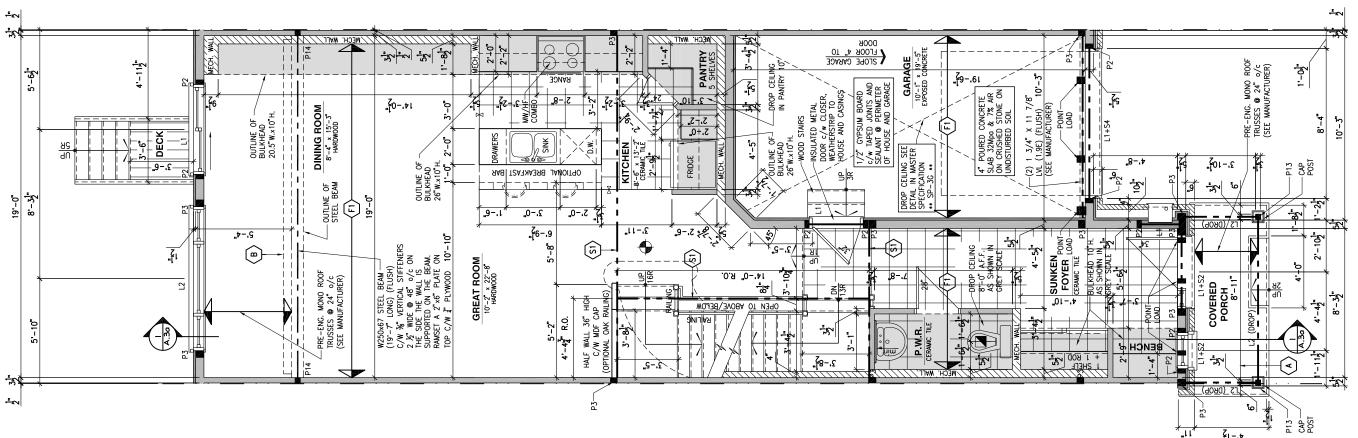

LOT: **XXXX** DATE: XX/XX/XXXX

Homes (2019) Limited

I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896
- TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

## STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10
- $S6 = L 200 \times 100 \times 12$
- S7 = L 150x100x10 (8" BEARING)

#### LINTEL TABLE:

- L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES
- L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES L4 = 3-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES
- IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

#### POST TABLE:

P1 = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-244 OR 2-2x6
P3 = 3-2x4 OR 3-2x6
P4 = 4-2x4 OR 4-2x6
P5 = 5-2x4 OR 5-2x6
P6 = 6-2x4 OR 6-2x6
P13 = HSS R8 0x88 0x 18 x 100x200x12 T&B P1

- P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)
- P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*)
- P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL.
- + 130×160×10 TOP PL. (\*) (\*) = 2-120 ANCH. (WHERE ANCH. PL. NOT USED)
- \* POST ARE ALL JACK c/w STUD
- (EX. P2 = 1 JACK + 1 STUD)

   IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

= SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
- SHALL HAVE A VISUAL SIGNALING DEVICE;
- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;
- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;
- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING

POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND — CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

## 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

## ORAWING: GROUND FLOOR PLAN **STANDARD KITCHEN - MID**

3/16" = 1'-0"

120 - THE HUNTLEY 2020 FOOTPRINT

(STANDARD DRAWINGS)

SHEET A.7d


xx/xx/xxxx

**GROUND FLOOR PLAN - STANDARD KITCHEN - MID UNIT** 

- > 11 %" PRE-ENG. OPEN JOIST TRIFORCE @ 19.2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE MANUFACTURER)
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

#### GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS
- PORCH CONSTRUCTION: TOP OF CONCRETE TO SLOPE 1" AWAY FROM HOUSE 8" SLOPED TO 7" POURED CONCRETE 32 Mpg 10M BARS @ 8" o/c EACH WAY PLUS 10M DOWELS 16" o/c WALL TO SLAB ON CLEAR STONE ON UNDISTURBED SOLL. SLAB TO BEAR ON FOUNDATION WALLS.
- PROVIDE A 10 1/2" x 3/8" STEEL PLATE (5 1/2" OVERHANG PASS EXTERIOR STUD FACE) WITH FULL 1/4" FILLET WELD TO FLANGE AT TOP AND 1" STITCH WELD AT 6" SPACING AT BOTTOM OF FLANGE. (STOP STEEL PLATE 6" SHORT AT BOTH ENDS OF BEAM TO ALLOW BEAM TO SIT ON TOP OF WALL)

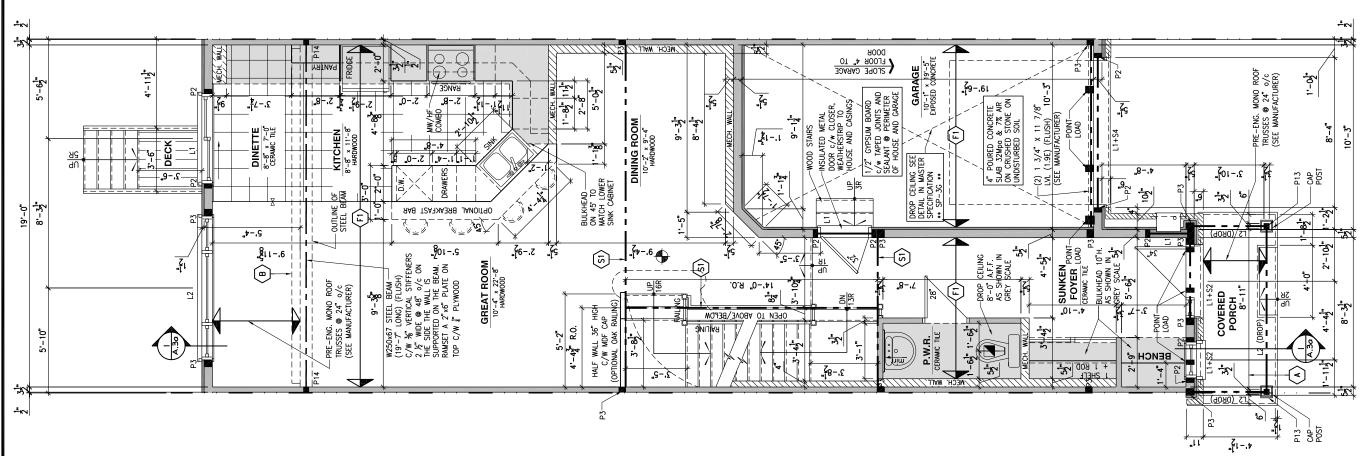

**GROUND FLOOR PLAN - OPTIONAL KITCHEN #1 - MID UNIT** 

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896
- TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

## STEEL LINTEL:

# S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10

- $S6 = L 200 \times 100 \times 12$
- S7 = L 150x100x10 (8" BEARING)

#### LINTEL TABLE:

- L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES
- L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES
- IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

#### POST TABLE:

P1 = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-244 OR 2-2x6
P3 = 3-2x4 OR 3-2x6
P4 = 4-2x4 OR 4-2x6
P5 = 5-2x4 OR 5-2x6
P6 = 6-2x4 OR 6-2x6
P13 = HSS R8 0x88 0x 18 x 100x200x12 T&B P1 P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)

P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*) P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL.

+ 130×160×10 TOP PL. (\*) (\*) = 2-12Ø ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)

• IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

= SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
- SHALL HAVE A VISUAL SIGNALING DEVICE;
- ARE RECOURED IN EACH SILEPING ROOM AND HALLWAY;
- ARE RECOURED ON EACH STOREY, INCLUDING BASEMENT;
- ARE RECOURED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING

ALTERNATIVE PURPLY CAPABLE OF PROVIDING.
POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION,
FOLLOWED BY, 4 MINUTES OF ALARM; AND
CARBON MONOXIDE ALARM ARE ALSO REQUIRED
ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

## 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

## RAWING: GROUND FLOOR PLAN **OPTIONAL KITCHEN #1 - MID**

3/16" = 1'-0" xx/xx/xxxx


120 - THE HUNTLEY 2020 FOOTPRINT

SHEET A.7e

- > 11 %" PRE-ENG. OPEN JOIST TRIFORCE @ 19.2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE MANUFACTURER)
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

#### GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS
- PORCH CONSTRUCTION: TOP OF CONCRETE TO SLOPE 1" AWAY FROM HOUSE 8" SLOPED TO 7" POURED CONCRETE 32 Mpg 10M BARS @ 8" o/c EACH WAY PLUS 10M DOWELS 16" o/c WALL TO SLAB ON CLEAR STONE ON UNDISTURBED SOLL. SLAB TO BEAR ON FOUNDATION WALLS.
  - PROVIDE A 10 1/2" x 3/8" STEEL PLATE (5 1/2" OVERHANG PASS EXTERIOR STUD FACE) WITH FULL 1/4" FILLET WELD TO FLANGE AT TOP AND 1" STITCH WELD AT 6" SPACING AT BOTTOM OF FLANGE. (STOP STEEL PLATE 6" SHORT AT BOTH ENDS OF BEAM TO ALLOW BEAM TO SIT ON TOP OF WALL)

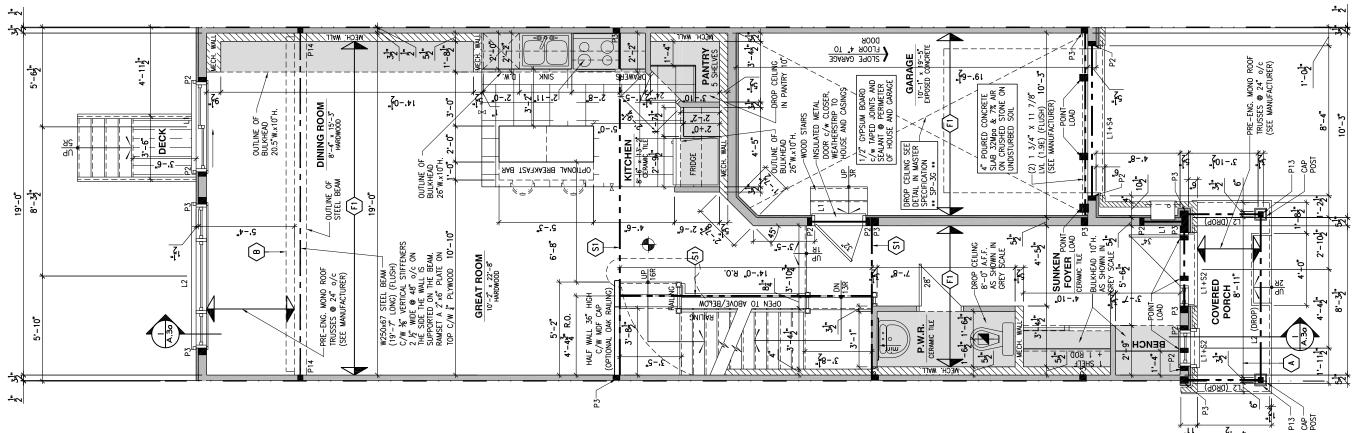

Homes (2019) Limited

I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

XXXX

XX/XX/XXXX

PERSONAL BCIN #19896

LOT:

DATE:

- TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANCES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

## STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10

- $S6 = L 200 \times 100 \times 12$ S7 = L 150x100x10 (8" BEARING)

#### LINTEL TABLE:

- L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES
- L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES L4 = 3-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES
- IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE

#### TREATED LUMBER POST TABLE:

P1 = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-244 OR 2-2x6
P3 = 3-2x4 OR 3-2x6
P4 = 4-2x4 OR 4-2x6
P5 = 5-2x4 OR 5-2x6
P6 = 6-2x4 OR 6-2x6
P13 = HSS R8 0x88 0x 18 x 100x200x12 T&B P1 P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)

P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*) P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL.

+ 130×160×10 TOP PL. (\*) (\*) = 2-12Ø ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)

• IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

= SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
- SHALL HAVE A VISUAL SIGNALING DEVICE;
- ARE RECOURED IN EACH SILEPING ROOM AND HALLWAY;
- ARE RECOURED ON EACH STOREY, INCLUDING BASEMENT;
- ARE RECOURED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING

POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND — CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

## 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

# RAWING: GROUND FLOOR PLAN **OPTIONAL KITCHEN #2 - MID**

3/16" = 1'-0" xx/xx/xxxx

120 - THE HUNTLEY 2020 FOOTPRINT

(STANDARD DRAWINGS)

SHEET A.7f

**GROUND FLOOR PLAN - OPTIONAL KITCHEN #2 - MID UNIT** 


- > 11 %" PRE-ENG. OPEN JOIST TRIFORCE @ 19.2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE MANUFACTURER)
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS

PORCH CONSTRUCTION: TOP OF CONCRETE TO SLOPE 1" AWAY FROM HOUSE 8" SLOPED TO 7" POURED CONCRETE 32 Mpg 10M
BARS @ 8" o/c EACH WAY PLUS 10M DOWELS 16" o/c
WALL TO SLAB ON CLEAR STONE ON UNDISTURBED
SOIL. SLAB TO BEAR ON FOUNDATION WALLS.

PROVIDE A 10 1/2" x 3/8" STEEL PLATE (5 1/2" OVERHANG PASS EXTERIOR STUD FACE) WITH FULL 1/4" FILLET WELD TO FLANGE AT TOP AND 1" STITCH WELD AT 6" SPACING AT BOTTOM OF FLANGE. (STOP STEEL PLATE 6" SHORT AT BOTH ENDS OF BEAM TO ALLOW BEAM TO SIT ON TOP OF WALL)

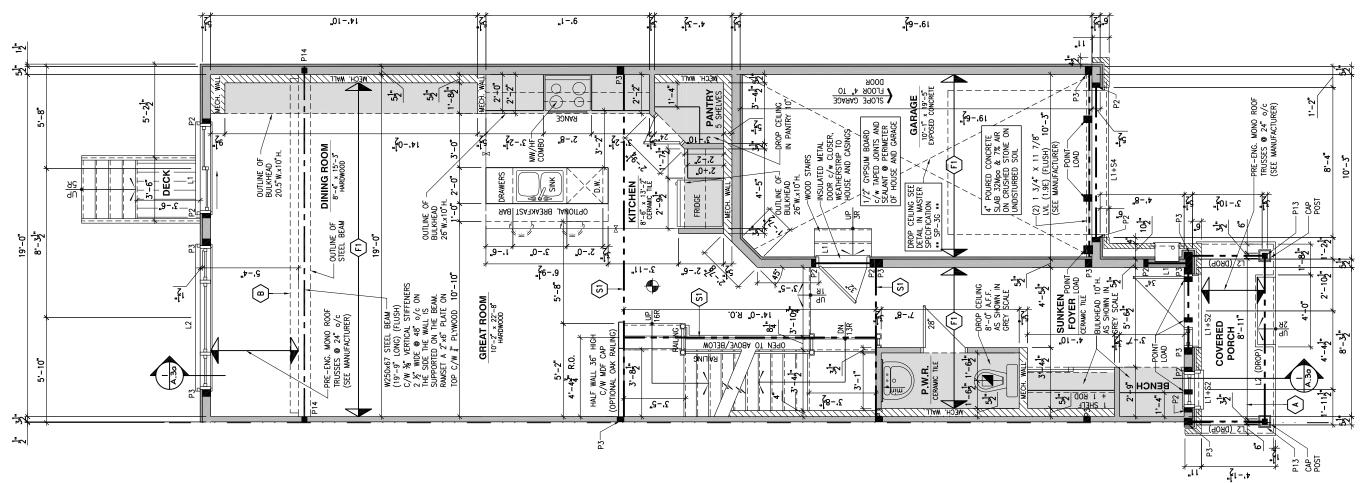

**GROUND FLOOR PLAN - STANDARD KITCHEN - GARAGE END UNIT** SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I. <u>Daniel Guerin</u> Architectural Manager for VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BCIN #19896
- TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

## STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10

- S7 = L 150x100x10 (8" BEARING)

#### LINTEL TABLE:

- L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES
- L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES L4 = 3-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES
- IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

#### POST TARLE

P1 = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-244 OR 2-2x6
P3 = 3-2x4 OR 3-2x6
P4 = 4-2x4 OR 4-2x6
P5 = 5-2x4 OR 5-2x6
P6 = 6-2x4 OR 6-2x6
P13 = HSS 88 0x88 0x 18 x 100x200x12 T&B P1

- P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)
- P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*)
- P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 O.D.x4.8 + 100x180x12 BOTTOM PL.
- + 130×160×10 TOP PL. (\*) (\*) = 2-12Ø ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)

• IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

= SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
- SHALL HAVE A VISUAL SIGNALING DEVICE;
- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;
- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;
- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING

POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND — CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

## 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

# DRAWING: GROUND FLOOR PLAN

# STANDARD KITCHEN-GARAGE END

3/16" = 1'-0" 120 - THE HUNTLEY

SHEET A.7g

XX/XX/XXXX


(STANDARD DRAWINGS)

2020 FOOTPRINT

- > 11 %" PRE-ENG. OPEN JOIST TRIFORCE @ 19.2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE MANUFACTURER)
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

#### GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS
- PORCH CONSTRUCTION: TOP OF CONCRETE TO SLOPE 1" AWAY FROM HOUSE 8" SLOPED TO 7" POURED CONCRETE 32 Mpg 10M
  BARS @ 8" o/c EACH WAY PLUS 10M DOWELS 16" o/c
  WALL TO SLAB ON CLEAR STONE ON UNDSTURBED
  SOIL. SLAB TO BEAR ON FOUNDATION WALLS.
  - PROVIDE A 10 1/2" x 3/8" STEEL PLATE (5 1/2" OVERHANG PASS EXTERIOR STUD FACE) WITH FULL 1/4" FILLET WELD TO FLANGE AT TOP AND 1" STITCH WELD AT 6" SPACING AT BOTTOM OF FLANGE. (STOP STEEL PLATE 6" SHORT AT BOTH ENDS OF BEAM TO ALLOW BEAM TO SIT ON TOP OF WALL)

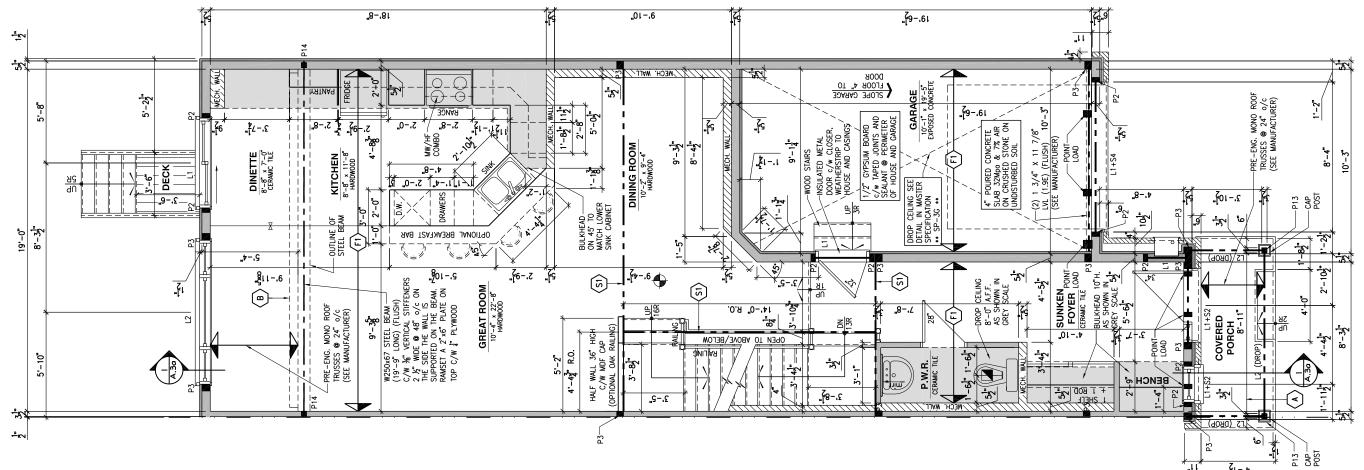

**GROUND FLOOR PLAN - OPTIONAL KITCHEN #1 - GARAGE END UNIT** SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896
- TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

## STEEL LINTEL:

S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10

 $S6 = L 200 \times 100 \times 12$ S7 = L 150x100x10 (8" BEARING)

#### LINTEL TABLE:

L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES

L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES

 IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

#### POST TABLE:

P1 = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-244 OR 2-2x6
P3 = 3-2x4 OR 3-2x6
P4 = 4-2x4 OR 4-2x6
P5 = 5-2x4 OR 5-2x6
P6 = 6-2x4 OR 6-2x6
P13 = HSS R8 0x88 0x 18 x 100x200x12 T&B P1 P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)

P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*)

P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL.

+ 130×160×10 TOP PL. (\*) (\*) = 2-12Ø ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)

• IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

= SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
- SHALL HAVE A VISUAL SIGNALING DEVICE;
- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;
- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;
- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING

POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND — CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

## 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

## DRAWING: GROUND FLOOR PLAN **OPT. KITCHEN #1 - GARAGE END**

3/16" = 1'-0" XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT


A.7h

SHEET

- > 11 %" PRE-ENG. OPEN JOIST TRIFORCE @ 19.2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE MANUFACTURER)
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS
- PORCH CONSTRUCTION: TOP OF CONCRETE TO SLOPE 1" AWAY FROM HOUSE 8" SLOPED TO 7" POURED CONCRETE 32 Mpg 10M
  BARS @ 8" o/c EACH WAY PLUS 10M DOWELS 16" o/c
  WALL TO SLAB ON CLEAR STONE ON UNDSTURBED
  SOIL. SLAB TO BEAR ON FOUNDATION WALLS.
- PROVIDE A 10 1/2" x 3/8" STEEL PLATE (5 1/2" OVERHANG PASS EXTERIOR STUD FACE) WITH FULL 1/4" FILLET WELD TO FLANGE AT TOP AND 1" STITCH WELD AT 6" SPACING AT BOTTOM OF FLANGE. (STOP STEEL PLATE 6" SHORT AT BOTH ENDS OF BEAM TO ALLOW BEAM TO SIT ON TOP OF WALL)

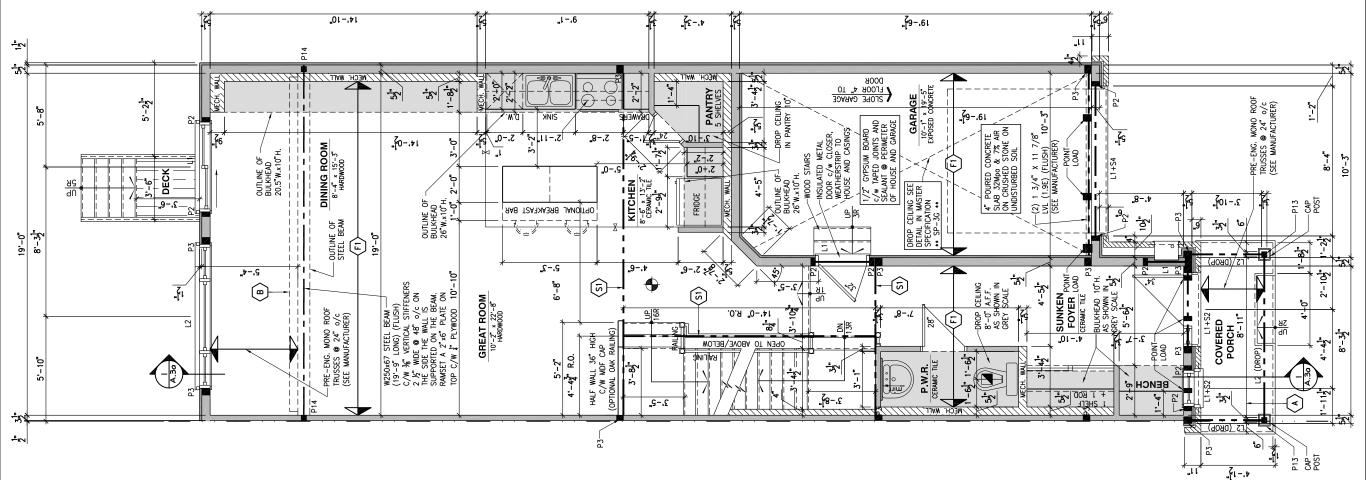

**GROUND FLOOR PLAN - OPTIONAL KITCHEN #2 - GARAGE END UNIT** 

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896
- TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

## STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10
- $S6 = L 200 \times 100 \times 12$
- S7 = L 150x100x10 (8" BEARING)

#### LINTEL TABLE:

- L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES
- L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES L4 = 3-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES
- IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

#### POST TARLE

P1 = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-244 OR 2-2x6
P3 = 3-2x4 OR 3-2x6
P4 = 4-2x4 OR 4-2x6
P5 = 5-2x4 OR 5-2x6
P6 = 6-2x4 OR 6-2x6
P13 = HSS R8 0x88 0x 18 x 100x200x12 T&B P1

- P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)

- P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*) P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL. + 130×160×10 TOP PL. (\*) (\*) = 2-12Ø ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)

• IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

= SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
- SHALL HAVE A VISUAL SIGNALING DEVICE;
- ARE RECOURED IN EACH SILEPING ROOM AND HALLWAY;
- ARE RECOURED ON EACH STOREY, INCLUDING BASEMENT;
- ARE RECOURED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING

POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND — CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

## 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

## ORAWING: GROUND FLOOR PLAN **OPT. KITCHEN #2 - GARAGE END**

3/16" = 1'-0" XX/XX/XXXX

120 - THE HUNTLEY

2020 FOOTPRINT (STANDARD DRAWINGS)

**A.7**i


SHEET

SCALE: 3/16" = 1'-0"

- , 11 1/8" PRE-ENG. OPEN JOIST TRIFORCE @ 19.2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE MANUFACTURER)
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

#### GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS
- PORCH CONSTRUCTION: TOP OF CONCRETE TO SLOPE 1" AWAY FROM HOUSE 8" SLOPED TO 7" POURED CONCRETE 32 Mpg 10M
  BARS @ 8" o/c EACH WAY PLUS 10M DOWELS 16" o/c
  WALL TO SLAB ON CLEAR STONE ON UNDSTURBED
  SOIL. SLAB TO BEAR ON FOUNDATION WALLS.
- PROVIDE A 10 1/2" x 3/8" STEEL PLATE (5 1/2" OVERHANG PASS EXTERIOR STUD FACE) WITH FULL 1/4" FILLET WELD TO FLANGE AT TOP AND 1" STITCH WELD AT 6" SPACING AT BOTTOM OF FLANGE. (STOP STEEL PLATE 6" SHORT AT BOTH ENDS OF BEAM TO ALLOW BEAM TO SIT ON TOP OF WALL)

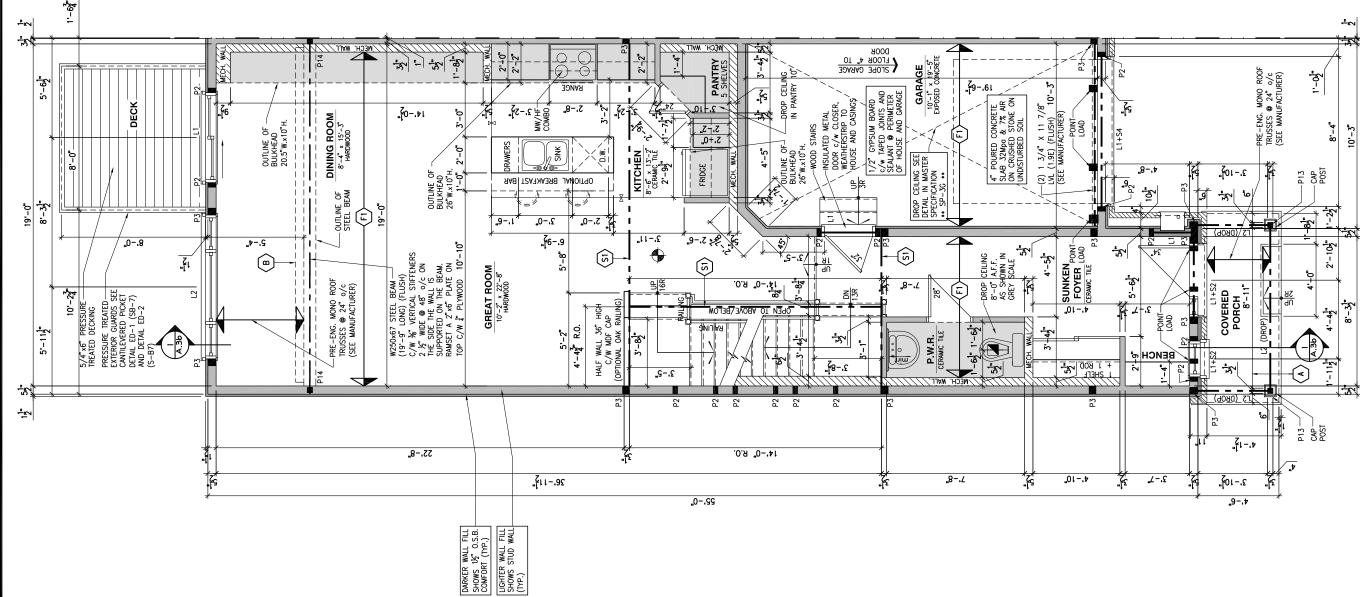

**GROUND FLOOR PLAN - WALKOUT - STANDARD KITCHEN - PORCH END UNIT** 

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896
- TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY 5HOW ONLY SOME OF THE CHANGE DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

## STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10

- $S6 = L 200 \times 100 \times 12$ S7 = L 150x100x10 (8" BEARING)

#### LINTEL TABLE:

- $L1 = 2-2\times10 + P2$  ON BOTH SIDES  $L2 = 3-2\times10 + P3$  ON BOTH SIDES
- L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES
- IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

#### POST TABLE

- P1 = 3" ADJUSTABLE STEEL COLUMN
  P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
  POST BY USP
  P2 = 2-244 OR 2-2x6
  P3 = 3-2x4 OR 3-2x6
  P4 = 4-2x4 OR 4-2x6
  P5 = 5-2x4 OR 5-2x6
  P6 = 6-2x4 OR 6-2x6
  P13 = HSS R8 0x88 0x 18 x 100x200x12 T&B P1
- P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)
- P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*)
- P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL.
- + 130×160×10 TOP PL. (\*) (\*) = 2-12Ø ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)

• IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

= SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
- SHALL HAVE A VISUAL SIGNALING DEVICE;
- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;
- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;
- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND — CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

## 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VΗ
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

# WGROUND FLOOR - WALKOUT

STANDARD KITCHEN - PORCH END

3/16" = 1'-0"

120 - THE HUNTLEY 2020 FOOTPRINT

**A.7**j


XX/XX/XXXX

SHEET

- > 11 %" PRE-ENG. OPEN JOIST TRIFORCE @ 19:2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE MANUFACTURER)
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

#### GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS
- PORCH CONSTRUCTION: TOP OF CONCRETE TO SLOPE 1" AWAY FROM HOUSE 8" SLOPED TO 7" POURED CONCRETE 32 Mpg 10M
  BARS @ 8" o/c EACH WAY PLUS 10M DOWELS 16" o/c
  WALL TO SLAB ON CLEAR STONE ON UNDSTURBED
  SOIL. SLAB TO BEAR ON FOUNDATION WALLS.
- PROVIDE A 10 1/2" x 3/8" STEEL PLATE (5 1/2" OVERHANG PASS EXTERIOR STUD FACE) WITH FULL 1/4" FILLET WELD TO FLANGE AT TOP AND 1" STITCH WELD AT 6" SPACING AT BOTTOM OF FLANGE. (STOP STEEL PLATE 6" SHORT AT BOTH ENDS OF BEAM TO ALLOW BEAM TO SIT ON TOP OF WALL)

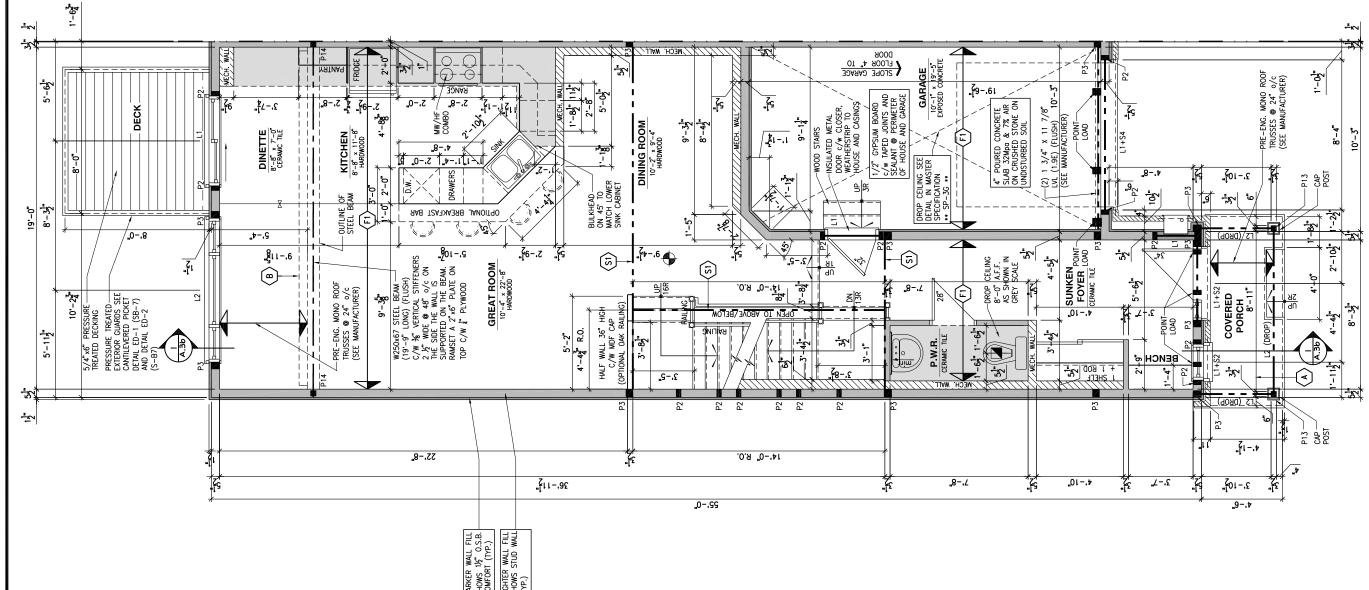

GROUND FLOOR PLAN - WALKOUT - OPTIONAL KITCHEN #1 - PORCH END UNIT

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896
- TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY 5HOW ONLY SOME OF THE CHANGE DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

## STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10
- $S6 = L 200 \times 100 \times 12$ S7 = L 150x100x10 (8" BEARING)

## LINTEL TABLE:

- L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES
- L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES
- IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

#### POST TABLE:

- P1 = 3" ADJUSTABLE STEEL COLUMN
  P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
  POST BY USP
  P2 = 2-244 OR 2-2x6
  P3 = 3-2x4 OR 3-2x6
  P4 = 4-2x4 OR 4-2x6
  P5 = 5-2x4 OR 5-2x6
  P6 = 6-2x4 OR 6-2x6
  P13 = HSS R8 0x88 0x 18 x 100x200x12 T&B P1
- P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)
- P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*) P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL.
- + 130×160×10 TOP PL. (\*)

  (\*) = 2-120 ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)

• IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

SMOKE ALARMS AS PER SECTION 9.10.19. OF THE
ONTARIO BUILDING CODE:

- SHALL HAVE A VISUAL SIGNALING DEVICE;

- ARE REQUIRED IN EACH SIEEPING ROOM AND HALLWAY;

- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT,

- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN
ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND — CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

## 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VΗ
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

## AWING: GROUND FLOOR - WALKOUT OPT. KITCHEN #1 - PORCH END

3/16" = 1'-0" 120 - THE HUNTLEY

2020 FOOTPRINT


SHEET A.7k

XX/XX/XXXX

- , 11 1/8" PRE-ENG. OPEN JOIST TRIFORCE @ 19:2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE MANUFACTURER)
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS
- PORCH CONSTRUCTION: TOP OF CONCRETE TO SLOPE 1" AWAY FROM HOUSE 8" SLOPED TO 7" POURED CONCRETE 32 Mpg 10M
  BARS @ 8" o/c EACH WAY PLUS 10M DOWELS 16" o/c
  WALL TO SLAB ON CLEAR STONE ON UNDSTURBED
  SOIL. SLAB TO BEAR ON FOUNDATION WALLS.
- PROVIDE A 10 1/2" x 3/8" STEEL PLATE (5 1/2" OVERHANG PASS EXTERIOR STUD FACE) WITH FULL 1/4" FILLET WELD TO FLANGE AT TOP AND 1" STITCH WELD AT 6" SPACING AT BOTTOM OF FLANGE. (STOP STEEL PLATE 6" SHORT AT BOTH ENDS OF BEAM TO ALLOW BEAM TO SIT ON TOP OF WALL)

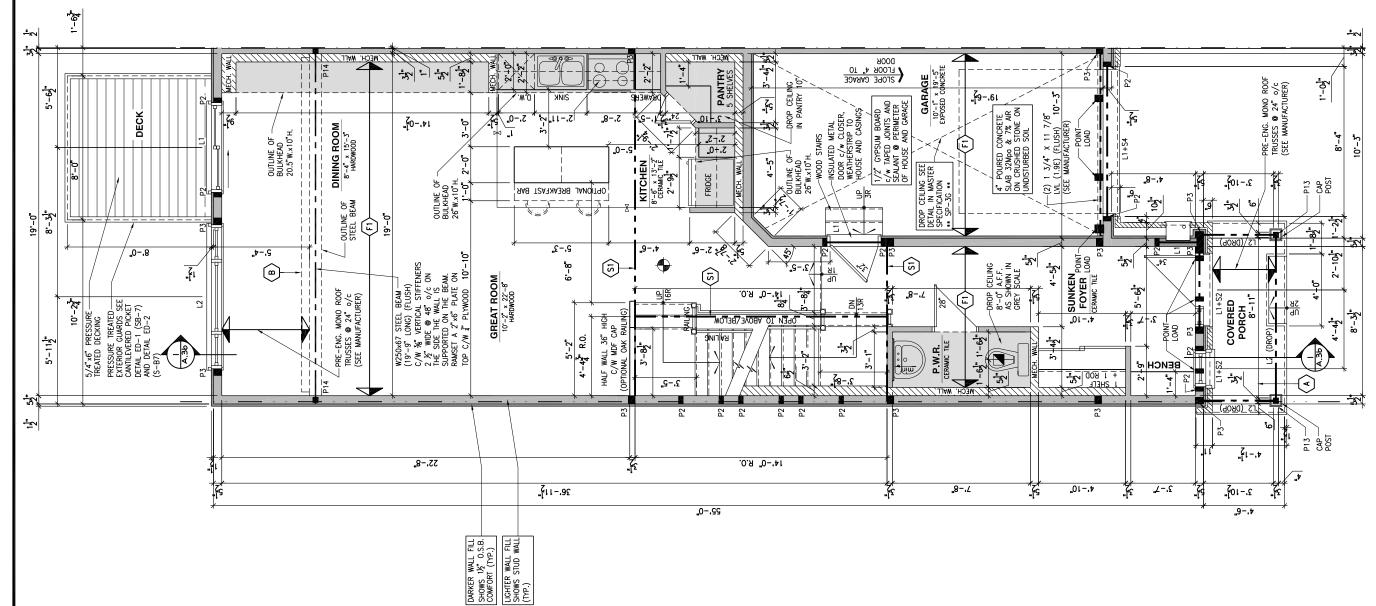

GROUND FLOOR PLAN - WALKOUT - OPTIONAL KITCHEN #2 - PORCH END UNIT

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896
- TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY 5HOW ONLY SOME OF THE CHANGE DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

## STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10
- $S6 = L 200 \times 100 \times 12$
- S7 = L 150x100x10 (8" BEARING)

#### LINTEL TABLE:

- L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES
- L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES
- IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

#### POST TABLE

P1 = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-244 OR 2-2x6
P3 = 3-2x4 OR 3-2x6
P4 = 4-2x4 OR 4-2x6
P5 = 5-2x4 OR 5-2x6
P6 = 6-2x4 OR 6-2x6
P13 = HSS R8 0x88 0x 18 x 100x200x12 T&B P1 P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)

P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*) P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL.

+ 130×160×10 TOP PL. (\*) (\*) = 2-12Ø ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)

• IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

= SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
- SHALL HAVE A VISUAL SIGNALING DEVICE;
- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;
- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;
- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING

POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND — CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

## 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

## AWING: GROUND FLOOR - WALKOUT **OPT. KITCHEN #2 -PORCH END**

3/16" = 1'-0"

XX/XX/XXXX SHEET

120 - THE HUNTLEY 2020 FOOTPRINT


(STANDARD DRAWINGS)

**A.7**I

- > 11 %" PRE-ENG. OPEN JOIST TRIFORCE @ 19:2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE MANUFACTURER)
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

#### GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS
- PORCH CONSTRUCTION: TOP OF CONCRETE TO SLOPE 1" AWAY FROM HOUSE 8" SLOPED TO 7" POURED CONCRETE 32 Mpg 10M
  BARS @ 8" o/c EACH WAY PLUS 10M DOWELS 16" o/c
  WALL TO SLAB ON CLEAR STONE ON UNDSTURBED
  SOIL. SLAB TO BEAR ON FOUNDATION WALLS.
  - PROVIDE A 10 1/2" x 3/8" STEEL PLATE (5 1/2" OVERHANG PASS EXTERIOR STUD FACE) WITH FULL 1/4" FILLET WELD TO FLANGE AT TOP AND 1" STITCH WELD AT 6" SPACING AT BOTTOM OF FLANGE. (STOP STEEL PLATE 6" SHORT AT BOTH ENDS OF BEAM TO ALLOW BEAM TO SIT ON TOP OF WALL)

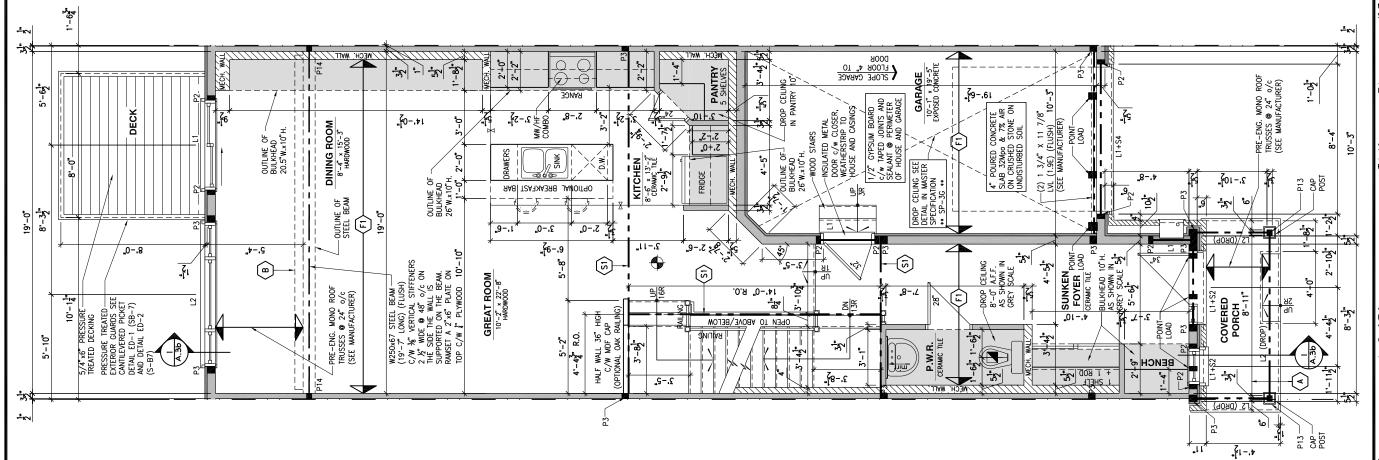



**GROUND FLOOR PLAN - WALKOUT - STANDARD KITCHEN - MID UNIT** 

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896
- TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY 5HOW ONLY SOME OF THE CHANGE DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

#### NOTES: STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10
- $S6 = L 200 \times 100 \times 12$
- S7 = L 150x100x10 (8" BEARING)

#### LINTEL TABLE:

- $L1 = 2-2\times10 + P2$  ON BOTH SIDES  $L2 = 3-2\times10 + P3$  ON BOTH SIDES
- L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES L4 = 3-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES
- IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

#### POST TABLE:

P1 = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-244 OR 2-2x6
P3 = 3-2x4 OR 3-2x6
P4 = 4-2x4 OR 4-2x6
P5 = 5-2x4 OR 5-2x6
P6 = 6-2x4 OR 6-2x6
P13 = HSS R8 0x88 0x 18 x 100x200x12 T&B P1

- P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)
- P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*) P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL.
- + 130×160×10 TOP PL. (\*) (\*) = 2-12Ø ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)

• IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

SMOKE ALARMS AS PER SECTION 9.10.19. OF THE
ONTARIO BUILDING CODE:

- SHALL HAVE A VISUAL SIGNALING DEVICE;

- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;

- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND

- CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

## 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

## RAWING: GROUND FLOOR - WALKOUT **STANDARD KITCHEN - MID**

SCALE: 3/16" = 1'-0"

XX/XX/XXXX SHEET

120 - THE HUNTLEY 2020 FOOTPRINT


(STANDARD DRAWINGS)

|A.7m|

- > 11 %" PRE-ENG. OPEN JOIST TRIFORCE @ 19.2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE MANUFACTURER)
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

#### GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS
- PORCH CONSTRUCTION: TOP OF CONCRETE TO SLOPE 1" AWAY FROM HOUSE 8" SLOPED TO 7" POURED CONCRETE 32 Mpg 10M BARS @ 8" o/c EACH WAY PLUS 10M DOWELS 16" o/c WALL TO SLAB ON CLEAR STONE ON UNDISTURBED SOLL. SLAB TO BEAR ON FOUNDATION WALLS.
- PROVIDE A 10 1/2" x 3/8" STEEL PLATE (5 1/2" OVERHANG PASS EXTERIOR STUD FACE) WITH FULL 1/4" FILLET WELD TO FLANGE AT TOP AND 1" STITCH WELD AT 6" SPACING AT BOTTOM OF FLANGE. (STOP STEEL PLATE 6" SHORT AT BOTH ENDS OF BEAM TO ALLOW BEAM TO SIT ON TOP OF WALL)

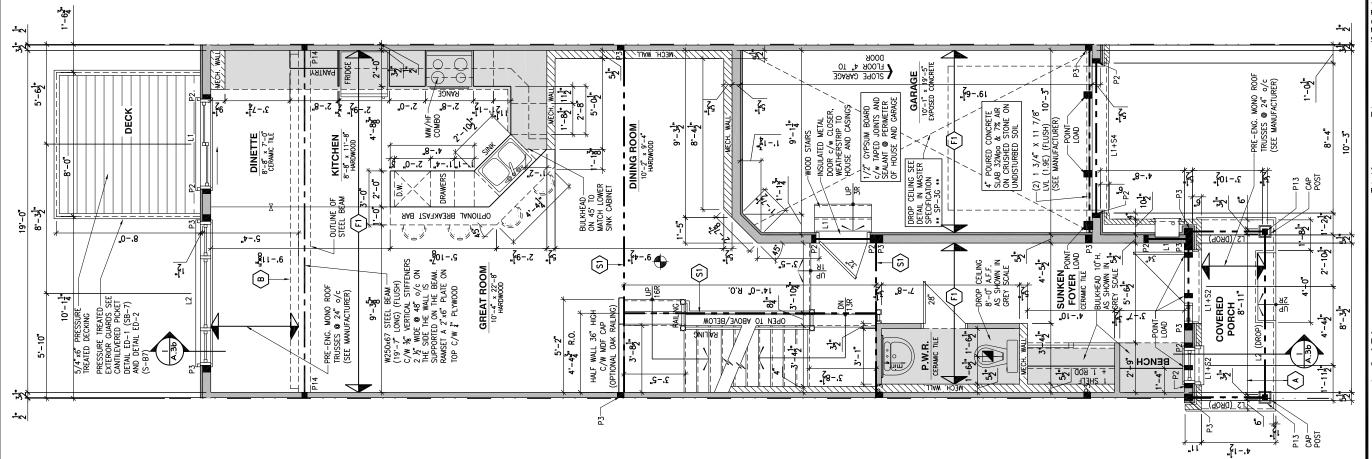

GROUND FLOOR PLAN - WALKOUT - OPTIONAL KITCHEN #1 - MID UNIT

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896
- TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY 5HOW ONLY SOME OF THE CHANGE DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

## STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10

- $S6 = L 200 \times 100 \times 12$
- S7 = L 150x100x10 (8" BEARING)

#### LINTEL TABLE:

- L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES
- L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES L4 = 3-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES
- IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

#### POST TABLE

P1 = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-244 OR 2-2x6
P3 = 3-2x4 OR 3-2x6
P4 = 4-2x4 OR 4-2x6
P5 = 5-2x4 OR 5-2x6
P6 = 6-2x4 OR 6-2x6
P13 = HSS R8 0x88 0x 18 x 100x200x12 T&B P1

- P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)
- P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*)
- P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL.
- + 130×160×10 TOP PL. (\*) (\*) = 2-12Ø ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)

• IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:

- SHALL HAVE A VISUAL SIGNALING DEVICE;

- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;

- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT,

- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND — CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

## 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VΗ
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VΗ
REV-1	NEW STANDARD DRWG MODIFICATION		MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

# RAWING: GROUND FLOOR - WALKOUT **OPTIONAL KITCHEN #1 - MID**

SCALE: 3/16" = 1'-0"

120 - THE HUNTLEY 2020 FOOTPRINT

A.7n


XX/XX/XXXX

SHEET

- , 11 1/8" PRE-ENG. OPEN JOIST TRIFORCE @ 19:2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE MANUFACTURER)
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

#### GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS
- PORCH CONSTRUCTION: TOP OF CONCRETE TO SLOPE 1" AWAY FROM HOUSE 8" SLOPED TO 7" POURED CONCRETE 32 Mpg 10M
  BARS @ 8" o/c EACH WAY PLUS 10M DOWELS 16" o/c
  WALL TO SLAB ON CLEAR STONE ON UNDSTURBED
  SOIL. SLAB TO BEAR ON FOUNDATION WALLS.
- PROVIDE A 10 1/2" x 3/8" STEEL PLATE (5 1/2" OVERHANG PASS EXTERIOR STUD FACE) WITH FULL 1/4" FILLET WELD TO FLANGE AT TOP AND 1" STITCH WELD AT 6" SPACING AT BOTTOM OF FLANGE. (STOP STEEL PLATE 6" SHORT AT BOTH ENDS OF BEAM TO ALLOW BEAM TO SIT ON TOP OF WALL)

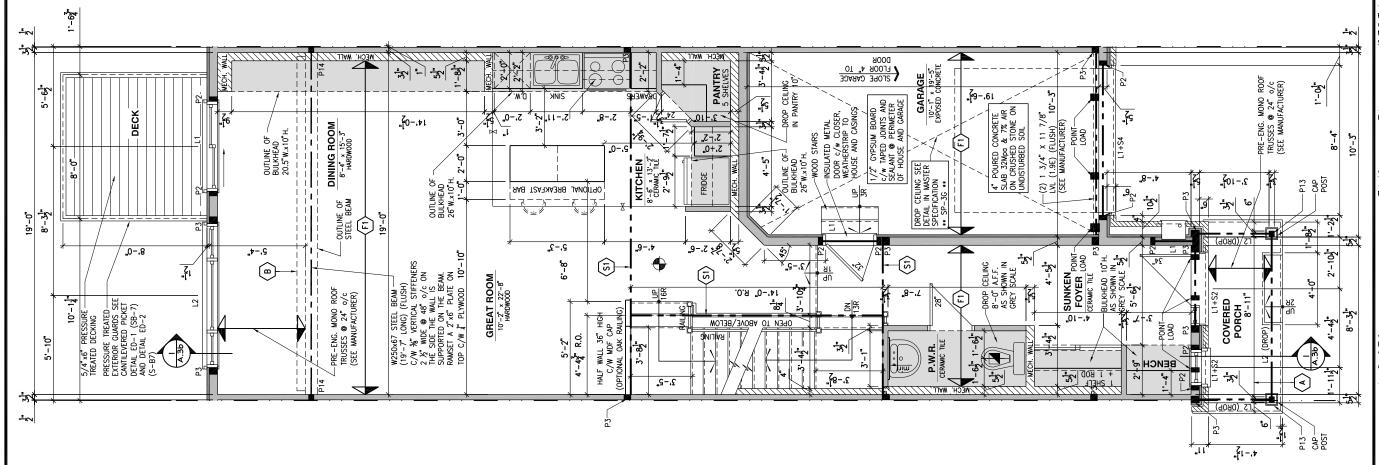

GROUND FLOOR PLAN - WALKOUT - OPTIONAL KITCHEN #2 - MID UNIT

120 - THE HUNTLEY 2020 FOOTPRINT

SHEET **A.7**o

XX/XX/XXXX

SCALE: 3/16" = 1'-0"

DATE: XX/XX/XXXX Homes (2019) Limited

I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

XXXX

PERSONAL BCIN #19896

LOT:

- TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY 5HOW ONLY SOME OF THE CHANGE DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

## STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10

- $S6 = L 200 \times 100 \times 12$ S7 = L 150x100x10 (8" BEARING)

#### LINTEL TABLE:

- L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES
- L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES L4 = 3-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES
- IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

#### POST TABLE

P1 = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-244 OR 2-2x6
P3 = 3-2x4 OR 3-2x6
P4 = 4-2x4 OR 4-2x6
P5 = 5-2x4 OR 5-2x6
P6 = 6-2x4 OR 6-2x6
P13 = HSS R8 0x88 0x 18 x 100x200x12 T&B P1

- P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)
- P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*) P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL.
- + 130×160×10 TOP PL. (\*) (\*) = 2-12Ø ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)

• IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

SMOKE ALARMS AS PER SECTION 9.10.19. OF THE
ONTARIO BUILDING CODE:

- SHALL HAVE A VISUAL SIGNALING DEVICE;

- ARE REQUIRED IN EACH SIEEPING ROOM AND HALLWAY;

- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT,

- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN
ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING

POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND — CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

# 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYO
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VΗ
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VΗ
REV-1	NEW STANDARD DRWG MODIFICATION		MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY


# AWING: GROUND FLOOR - WALKOUT **OPTIONAL KITCHEN #2 - MID**

SCALE: 3/16" = 1'-0"

- > 11 %" PRE-ENG. OPEN JOIST TRIFORCE @ 19:2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE MANUFACTURER)
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS
- PORCH CONSTRUCTION: TOP OF CONCRETE TO SLOPE 1" AWAY FROM HOUSE 8" SLOPED TO 7" POURED CONCRETE 32 Mpg 10M
  BARS @ 8" o/c EACH WAY PLUS 10M DOWELS 16" o/c
  WALL TO SLAB ON CLEAR STONE ON UNDISTURBED
  SOIL. SLAB TO BEAR ON FOUNDATION WALLS.
  - PROVIDE A 10 1/2" x 3/8" STEEL PLATE (5 1/2" OVERHANG PASS EXTERIOR STUD FACE) WITH FULL 1/4" FILLET WELD TO FLANGE AT TOP AND 1" STITCH WELD AT 6" SPACING AT BOTTOM OF FLANGE. (STOP STEEL PLATE 6" SHORT AT BOTH ENDS OF BEAM TO ALLOW BEAM TO SIT ON TOP OF WALL)

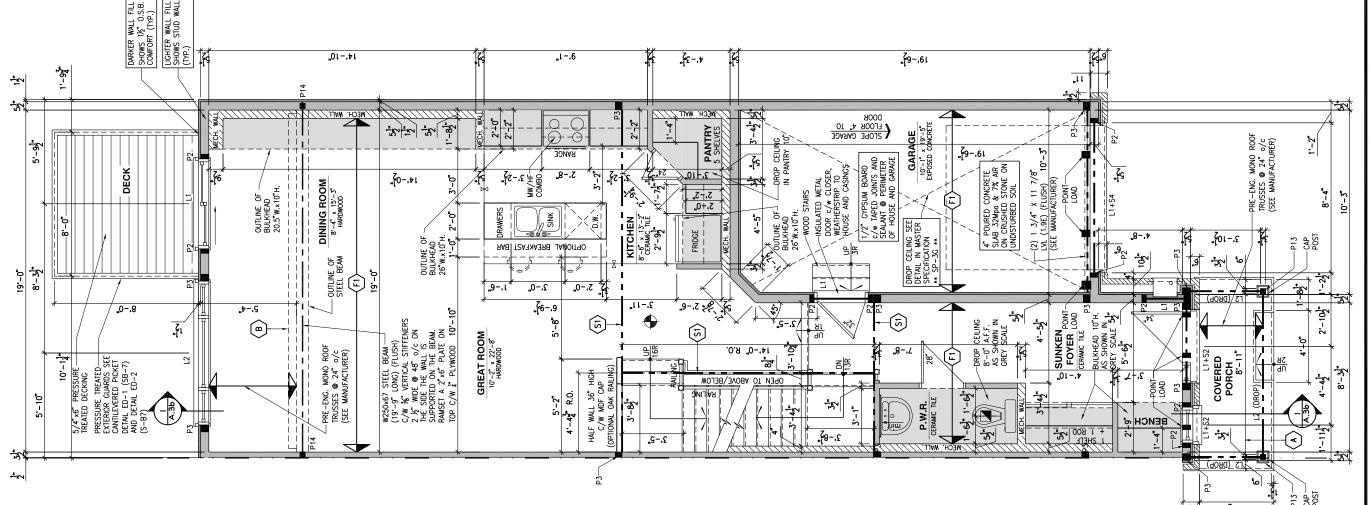



SCALE: 3/16" = 1'-0"

GROUND FLOOR PLAN - WALKOUT - STANDARD KITCHEN - GARAGE END UNIT

LOT: XXXX DATE: XX/XX/XXXX



I. <u>Daniel Guerin</u> Architectural Manager for VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BCIN #19896
- TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

## NOTES: STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10
- $S6 = L 200 \times 100 \times 12$
- S7 = L 150x100x10 (8" BEARING)

#### LINTEL TABLE:

- L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES
- L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES L4 = 3-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES
- IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

#### POST TABLE:

P1 = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-244 OR 2-2x6
P3 = 3-2x4 OR 3-2x6
P4 = 4-2x4 OR 4-2x6
P5 = 5-2x4 OR 5-2x6
P6 = 6-2x4 OR 6-2x6
P13 = HSS 88 0x88 0x 18 x 100x200x12 T&B P1

- P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)
- P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*)
- P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 O.D.x4.8 + 100x180x12 BOTTOM PL. (\*) = 2-120 ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)

• IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

= SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
- SHALL HAVE A VISUAL SIGNALING DEVICE;
- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;
- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;
- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION,
FOLLOWED BY, 4 MINUTES OF ALARM; AND
— CARBON MONOXIDE ALARM ARE ALSO REQUIRED
ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

## 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

# AWIGHOUND FLOOR - WALKOUT

3/16" = 1'-0"

XX/XX/XXXX

**A.**7p

SHEET


STANDARD KITCHEN-GARAGE END

120 - THE HUNTLEY 2020 FOOTPRINT

- > 11 %" PRE-ENG. OPEN JOIST TRIFORCE @ 19:2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE MANUFACTURER)
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS
- PORCH CONSTRUCTION: TOP OF CONCRETE TO SLOPE 1" AWAY FROM HOUSE 8" SLOPED TO 7" POURED CONCRETE 32 Mpg 10M
  BARS @ 8" o/c EACH WAY PLUS 10M DOWELS 16" o/c
  WALL TO SLAB ON CLEAR STONE ON UNDISTURBED
  SOIL. SLAB TO BEAR ON FOUNDATION WALLS.
- PROVIDE A 10 1/2" x 3/8" STEEL PLATE (5 1/2" OVERHANG PASS EXTERIOR STUD FACE) WITH FULL 1/4" FILLET WELD TO FLANGE AT TOP AND 1" STITCH WELD AT 6" SPACING AT BOTTOM OF FLANGE. (STOP STEEL PLATE 6" SHORT AT BOTH ENDS OF BEAM TO ALLOW BEAM TO SIT ON TOP OF WALL)

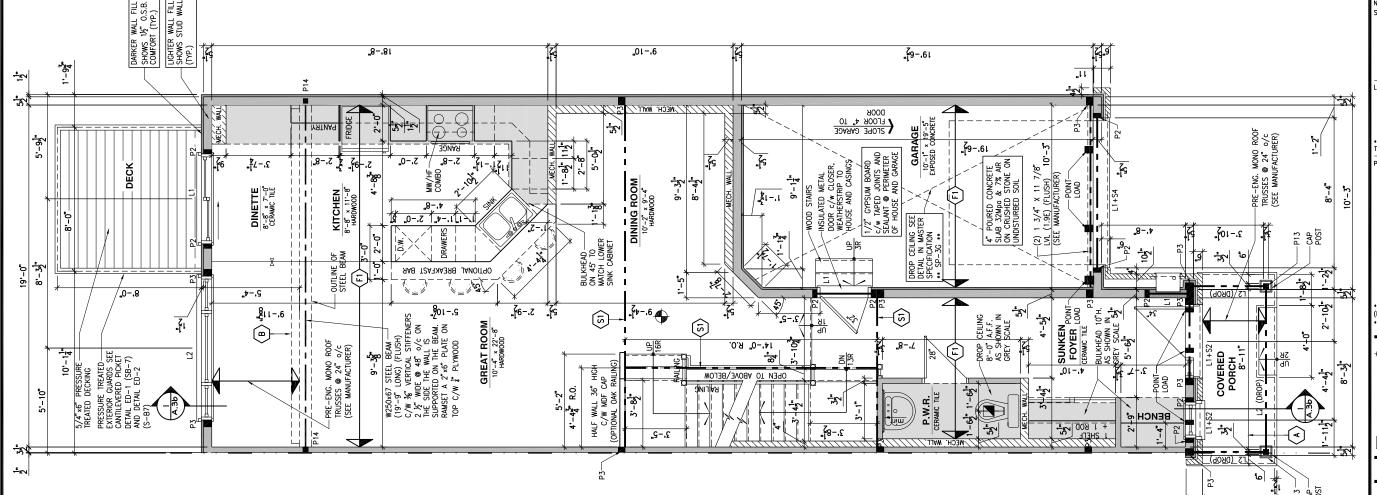

GROUND FLOOR PLAN - WALKOUT - OPTIONAL KITCHEN #1 - GARAGE END UNIT

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I. <u>Daniel Guerin</u> Architectural Manager for VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BCIN #19896
- TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

## NOTES: STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10
- $S6 = L 200 \times 100 \times 12$
- S7 = L 150x100x10 (8" BEARING)

#### LINTEL TABLE:

- L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES
- L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES L4 = 3-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES
- IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

#### POST TABLE:

- P1 = 3" ADJUSTABLE STEEL COLUMN
  P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
  POST BY USP
  P2 = 2-244 OR 2-2x6
  P3 = 3-2x4 OR 3-2x6
  P4 = 4-2x4 OR 4-2x6
  P5 = 5-2x4 OR 5-2x6
  P6 = 6-2x4 OR 6-2x6
  P13 = HSS 88 0x88 0x 18 x 100x200x12 T&B P1
- P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)
- P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*) P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL. + 130×160×10 TOP PL. (\*)

  (\*) = 2-12Ø ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)

• IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

= SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
- SHALL HAVE A VISUAL SIGNALING DEVICE;
- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;
- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;
- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING

POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION,
FOLLOWED BY, 4 MINUTES OF ALARM; AND
— CARBON MONOXIDE ALARM ARE ALSO REQUIRED
ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

## 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VΗ
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

## AWING: GROUND FLOOR - WALKOUT **OPT. KITCHEN #1 - GARAGE END**

3/16" = 1'-0"

XX/XX/XXXX SHEET

120 - THE HUNTLEY 2020 FOOTPRINT


(STANDARD DRAWINGS)

A.7q

- , 11 1/8" PRE-ENG. OPEN JOIST TRIFORCE @ 19:2" o/c c/w STRAPPING UNLESS OTHERWISE NOTED (SEE MANUFACTURER)
- F2 2" x 8" JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- F3 2" x 8" PRESSURE TREATED JOIST @ 16" o/c UNLESS OTHERWISE NOTED
- REFER TO FLOOR JOIST LAYOUT SHOP DRAWINGS FOR ALL TRIMMER AND HEADER JOISTS AT FLOOR OPENING (UNLESS OTHERWISE NOTED)

GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS
- PORCH CONSTRUCTION: TOP OF CONCRETE TO SLOPE 1" AWAY FROM HOUSE 8" SLOPED TO 7" POURED CONCRETE 32 Mpo 10M
  BARS @ 8" o/c EACH WAY PLUS 10M DOWELS 16" o/c
  WALL TO SLAB ON CLEAR STONE ON UNDISTURBED SOIL SLAB TO BEAR ON FOUNDATION WALLS.
- PROVIDE A 10 1/2" x 3/8" STEEL PLATE (5 1/2" OVERHANG PASS EXTERIOR STUD FACE) WITH FULL 1/4" FILLET WELD TO FLANGE AT TOP AND 1" STITCH WELD AT 6" SPACING AT BOTTOM OF FLANGE. (STOP STEEL PLATE 6" SHORT AT BOTH ENDS OF BEAM TO ALLOW BEAM TO SIT ON TOP OF WALL)

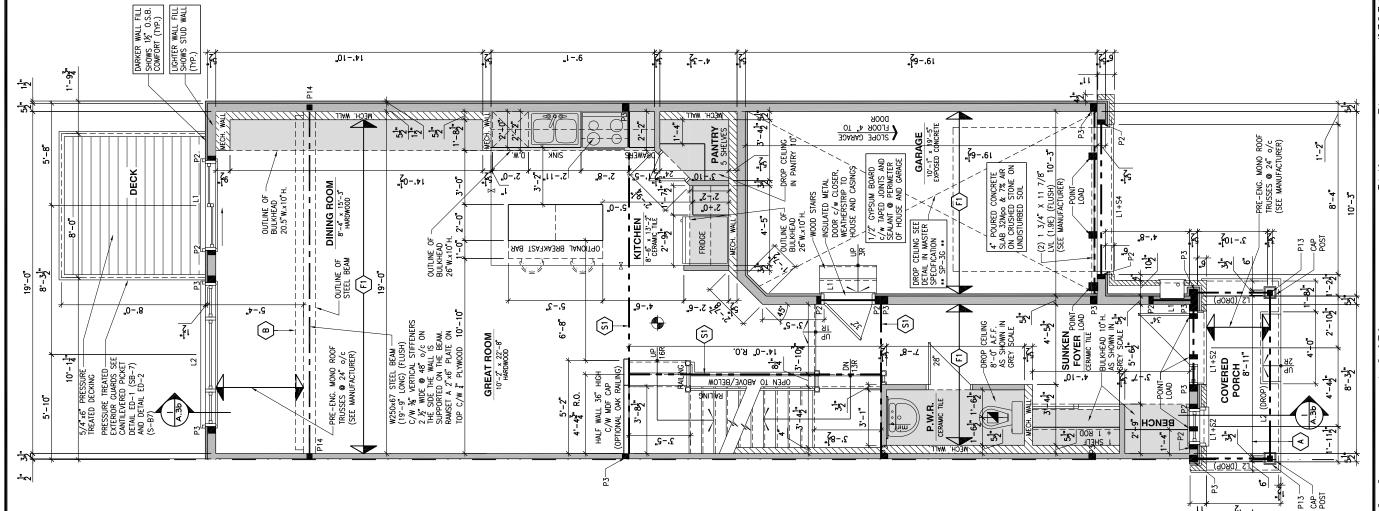

GROUND FLOOR PLAN - WALKOUT - OPTIONAL KITCHEN #2 - GARAGE END UNIT

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896
- TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY 5HOW ONLY SOME OF THE CHANGE DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

## NOTES: STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10
- $S6 = L 200 \times 100 \times 12$ S7 = L 150x100x10 (8" BEARING)

LINTEL TABLE:

- L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES
- L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES L4 = 3-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES
- IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

POST TABLE:

P1 = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-244 OR 2-2x6
P3 = 3-2x4 OR 3-2x6
P4 = 4-2x4 OR 4-2x6
P5 = 5-2x4 OR 5-2x6
P6 = 6-2x4 OR 6-2x6
P13 = HSS R8 0x88 0x 18 x 100x200x12 T&B P1 P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)

P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (\*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*) P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*) P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL.

+ 130×160×10 TOP PL. (\*) (\*) = 2-12Ø ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)

• IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

= SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
- SHALL HAVE A VISUAL SIGNALING DEVICE;
- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;
- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;
- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING

POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND — CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

## 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VΗ
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

## AWING: GROUND FLOOR - WALKOUT **OPT. KITCHEN #2 -GARAGE END**


(STANDARD DRAWINGS)

SCALE: 3/16" = 1'-0" XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT

A.7r

SHEET

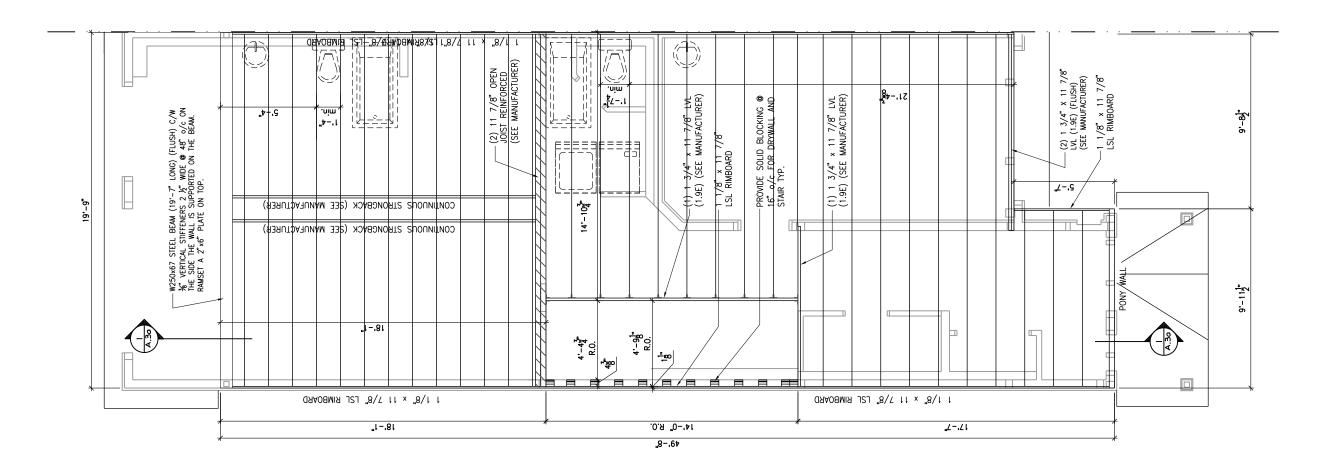

SECOND FLOOR - FLOOR JOIST FRAMING PLAN - STANDARD ENSUITE - PORCH END UNIT

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>DANIEL GUERIN</u> ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY


RAWING: SECOND FLOOR - FLOOR

**JOIST FRAMING - PORCH END** | SCALE: | 3/16" = 1'-0" DATE: XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT

(STANDARD DRAWINGS)

SHEET: A.8a

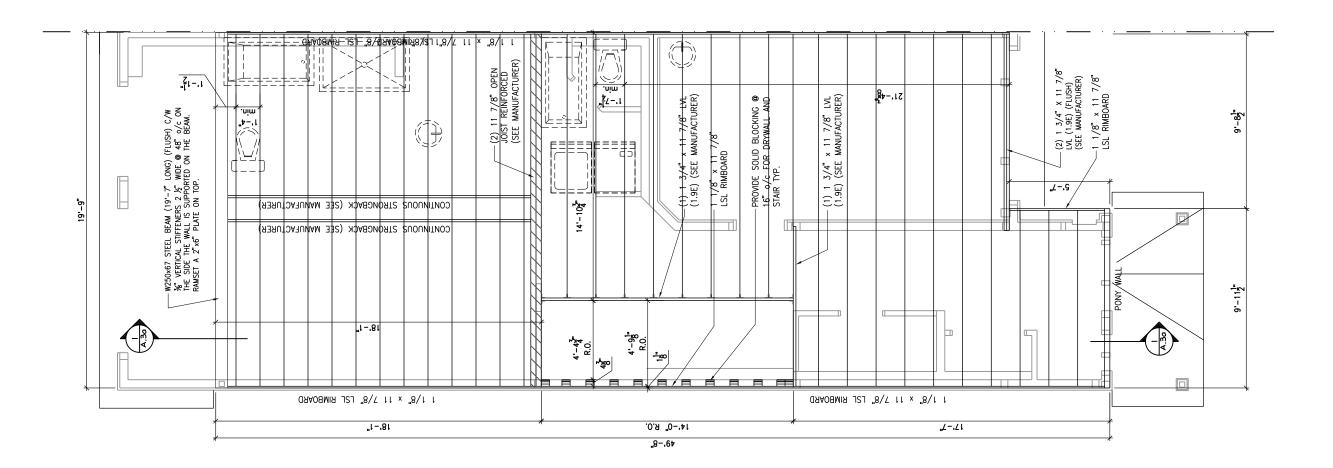

SECOND FLOOR - FLOOR JOIST FRAMING PLAN - OPTIONAL 4 PC ENSUITE - PORCH END UNIT

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>DANIEL GUERIN</u> ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

•• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.C. DRAWINGS

I			
REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	RY

RAWING: SECOND FLOOR - FLOOR

**JOIST FRAMING - PORCH END** 

| SCALE: | 3/16" = 1'-0" DATE: XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT

(STANDARD DRAWINGS)

A.8b

SHEET:

SECOND FLOOR - FLOOR JOIST FRAMING PLAN - OPTIONAL 5 PC ENSUITE - PORCH END UNIT

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valegraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896 - TARION REGISTRATION NUMBER #611

\*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*\*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT, SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

# 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VΗ
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VΗ
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

RAWING: SECOND FLOOR - FLOOR


**JOIST FRAMING - PORCH END** | SCALE: | DATE: | XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT

(STANDARD DRAWINGS)

A.8c

SHEET:

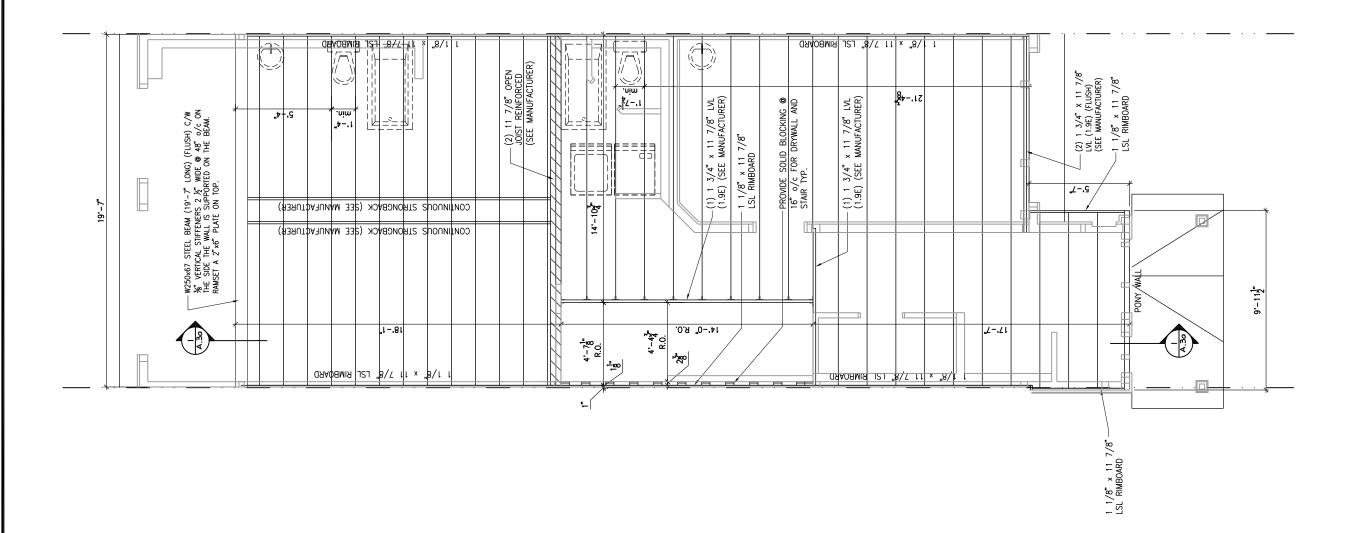

(A.8d)

SECOND FLOOR - FLOOR JOIST FRAMING PLAN - STANDARD ENSUITE - MID UNIT

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valegraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE
B-1A AND ANY 680'S AND MAY 5HOW ONLY SOME OF THE CHANGES
DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW
ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS
ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING
DOCUMENT DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

## 2012 O.B.C. DRAWINGS


REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

RAWING: SECOND FLOOR - FLOOR

**JOIST FRAMING PLAN-MID** DATE: XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT

SHEET: A.8d

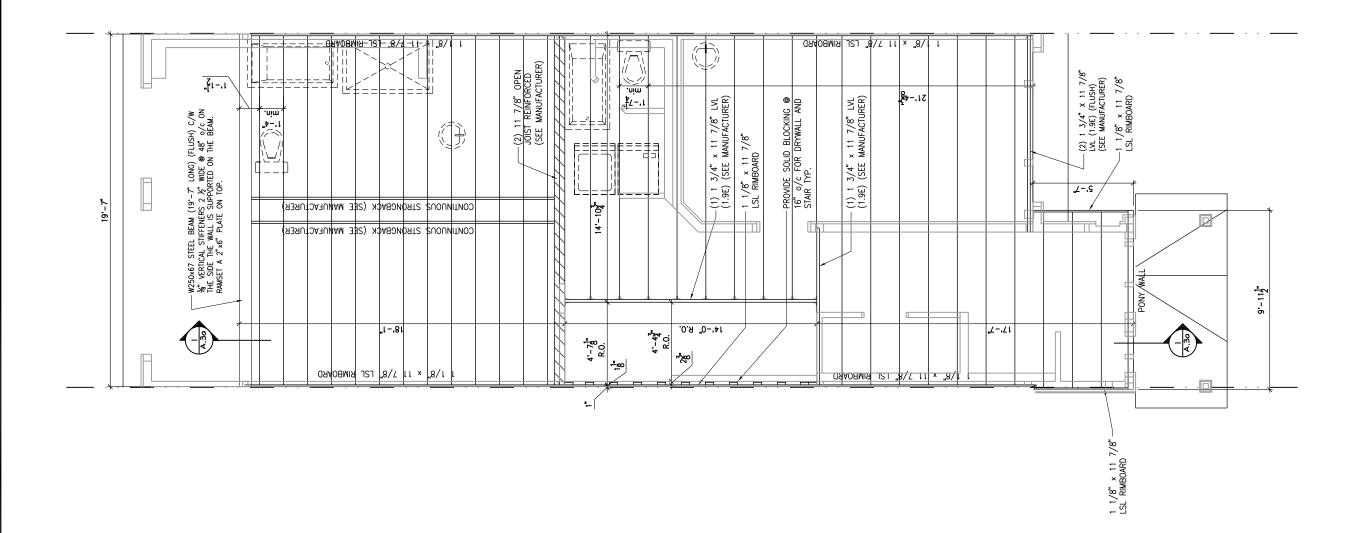

SECOND FLOOR - FLOOR JOIST FRAMING PLAN - OPTIONAL 4 PC ENSUITE - MID UNIT

SCALE: 3/16" = 1'-0"

DATE: XX/XX/XXXX

XXXX

Valecraft Homes (2019) Limited

I<u>, Daniel Guerin</u>, architectural manager for Valegraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

LOT:

•• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM ••

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE
B-1A AND ANY 680'S AND MAY 5HOW ONLY SOME OF THE CHANGES
DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW
ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS
ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING
DOCUMENT DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.C. DRAWINGS

l			
REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYOR
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

RAWING: SECOND FLOOR - FLOOR

**JOIST FRAMING PLAN - MID** DATE: XX/XX/XXXX

| SCALE: | 3/16" = 1'-0"

120 - THE HUNTLEY 2020 FOOTPRINT

(STANDARD DRAWINGS)

SHEET: A.8e

SECOND FLOOR - FLOOR JOIST FRAMING PLAN - OPTIONAL 5 PC ENSUITE - MID UNIT

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valegraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896 - TARION REGISTRATION NUMBER #611

\*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*\*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT, SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.C. DRAWINGS


REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

RAWING: SECOND FLOOR - FLOOR **JOIST FRAMING PLAN - MID** 

| SCALE: | DATE: | XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT

SHEET: A.8f

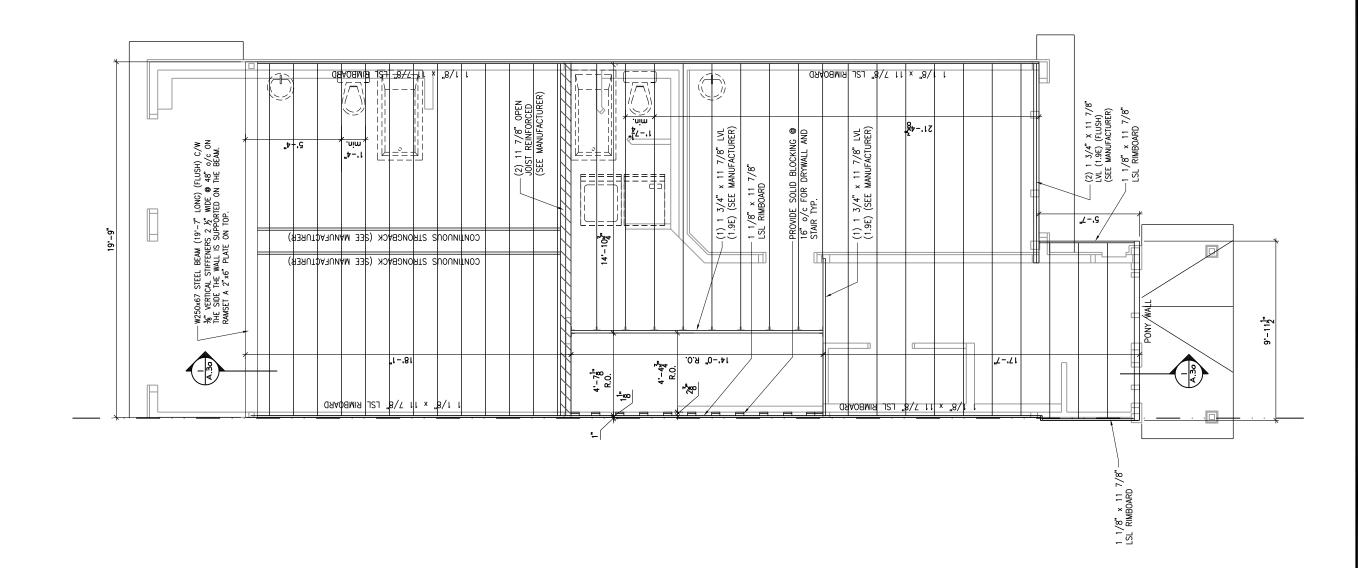

(A.8g)

SECOND FLOOR - FLOOR JOIST FRAMING PLAN - STANDARD ENSUITE - GARAGE END UNIT

SCALE: 3/16" = 1'-0"

DATE: XX/XX/XXXX SHEET: A.8g

LOT: XXXX DATE: XX/XX/XXXX

Homes (2019) Limited

I<u>, Daniel Guerin</u>, architectural manager for Valegraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

PERSONAL BCIN #19896
TARION REGISTRATION NUMBER #611

•• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM ••

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE
B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES
DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW
ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS
ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING
DOCUMENT. DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.


2012 O.B.C. DRAWINGS

REV-4 NEW STANDARD DRWG MODIFICATION 01/01/2021 DOYON REV-3 AS PER STRUCTURAL REVIEW 03/20/2019 VH 11/07/2018 VH REV-2 AS PER STRUCTURAL REVIEW REY-1 NEW STANDARD DRWG MODIFICATION 11/13/2017 MAD
NO. DESCRIPTION MM/DD/YYYY BY

DRAWING: SECOND FLOOR - FLOOR **JOIST FRAMING - GARAGE END** 

SCALE: 3/16" = 1'-0"

120 - THE HUNTLEY 2020 FOOTPRINT

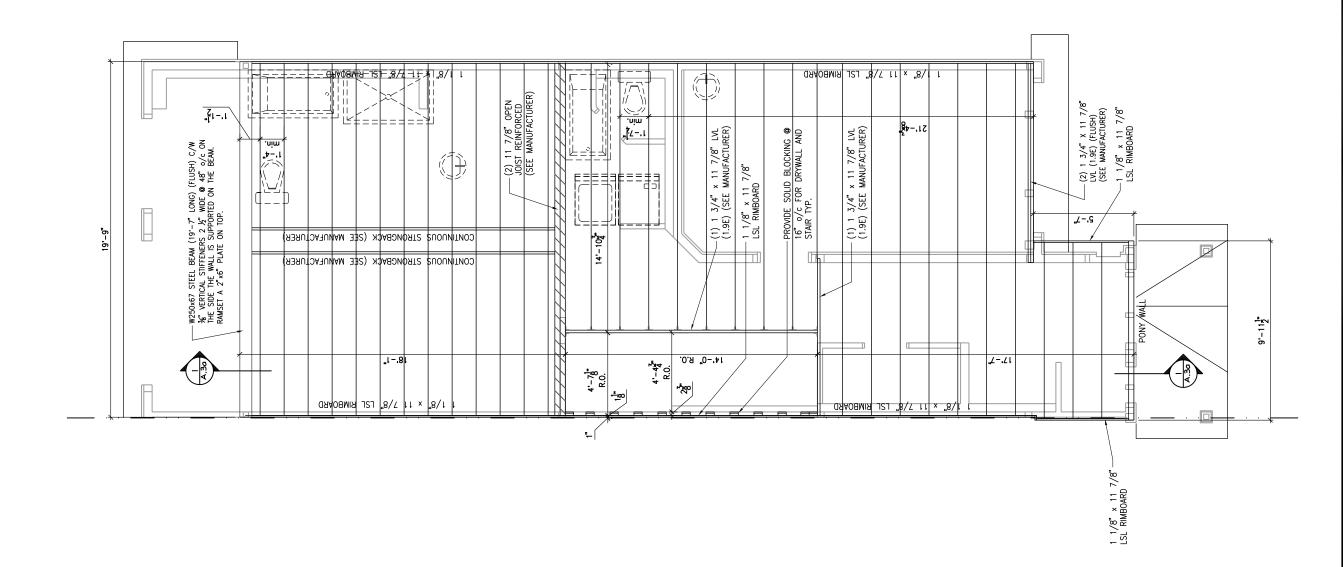

SECOND FLOOR - FLOOR JOIST FRAMING PLAN - OPTIONAL 4 PC ENSUITE - GARAGE END UNIT

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valegraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY 5HOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.C. DRAWINGS

l			
REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

RAWING: SECOND FLOOR - FLOOR

**JOIST FRAMING - GARAGE END** 

| SCALE: | 3/16" = 1'-0"

120 - THE HUNTLEY 2020 FOOTPRINT

(STANDARD DRAWINGS)

A.8h

DATE: XX/XX/XXXX

SHEET:



SECOND FLOOR - FLOOR JOIST FRAMING PLAN - OPTIONAL 5 PC ENSUITE - GARAGE END UNIT

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valegraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896 - TARION REGISTRATION NUMBER #611

\*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*\*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT, SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

# 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

## RAWING: SECOND FLOOR - FLOOR **JOIST FRAMING - GARAGE END**


| SCALE: | DATE: | XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT

SHEET: A.8i

#### GENERAL NOTES:

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER
  TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS

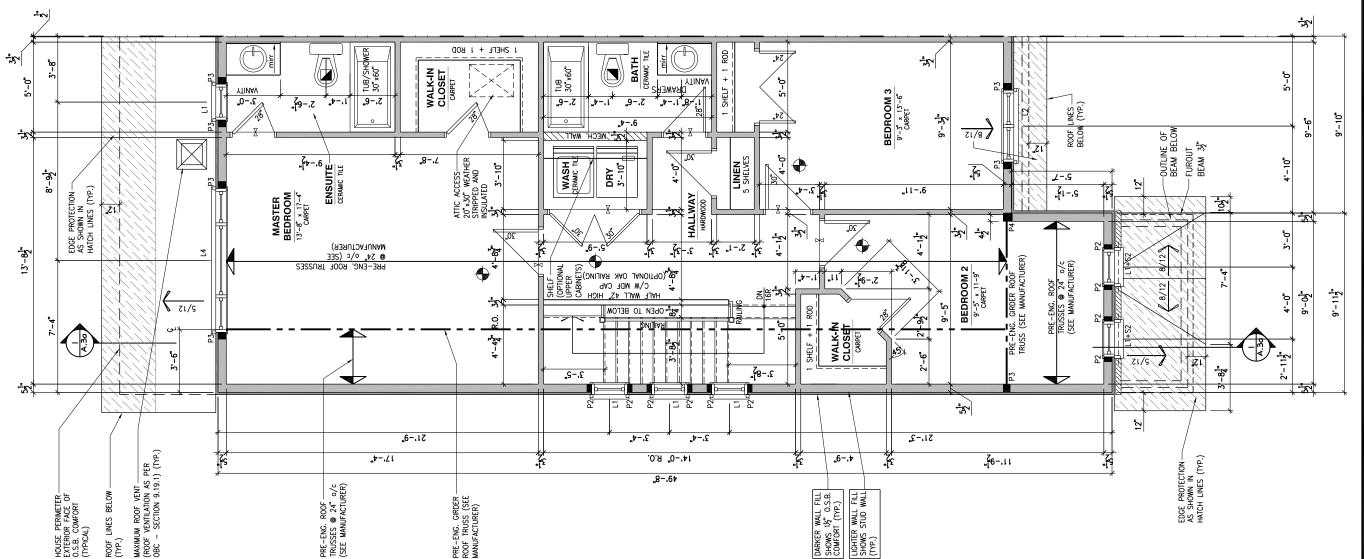

LOT: **XXXX** DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

\*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANCES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

## STEEL LINTEL:

S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10

 $S6 = L 200 \times 100 \times 12$ 

S7 = L 150x100x10 (8" BEARING)

#### LINTEL TABLE:

L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES

L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES L4 = 3-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES

IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

#### POST TABLE:

P1 = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-244 OR 2-2x6
P3 = 3-2x4 OR 3-2x6
P4 = 4-2x4 OR 4-2x6
P5 = 5-2x4 OR 5-2x6
P6 = 6-2x4 OR 6-2x6
P13 = HSS R8 0x88 0x 18 x 100x200x12 T&B P1 P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)

13 63 83 83 89 4.8 + 100 200 x12 1 & B PL. (\*) P15 = HSS 88 x89 x4.8 + 100 x200 x12 1 & B PL. (\*) P15 = HSS 76 2 x76 2 x4.78 + 100 x180 x12 1 & B PL. (\*) P16 = HSS 76 2 x76 2 x4.78 + 130 x130 x12 1 & B PL. (\*) P17 = HSS 73 0.0 x4.8 + 100 x180 x12 BOTTOM PL.

+ 130×160×10 TOP PL. (\*) (\*) = 2-12Ø ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)

• IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

SMOKE ALARMS AS PER SECTION 9.10.19. OF THE
ONTARIO BUILDING CODE:

- SHALL HAVE A VISUAL SIGNALING DEVICE;

- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;

- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND

- CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

## 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VΗ
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

DRAWING: SECOND FLOOR PLAN

STANDARD ENSUITE - PORCH END SCALE: 3/16" = 1'-0"

120 - THE HUNTLEY


2020 FOOTPRINT A.9a (STANDARD DRAWINGS)

XX/XX/XXXX

SHEET

**SECOND FLOOR PLAN - STANDARD ENSUITE - PORCH END UNIT** 

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER
  TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS

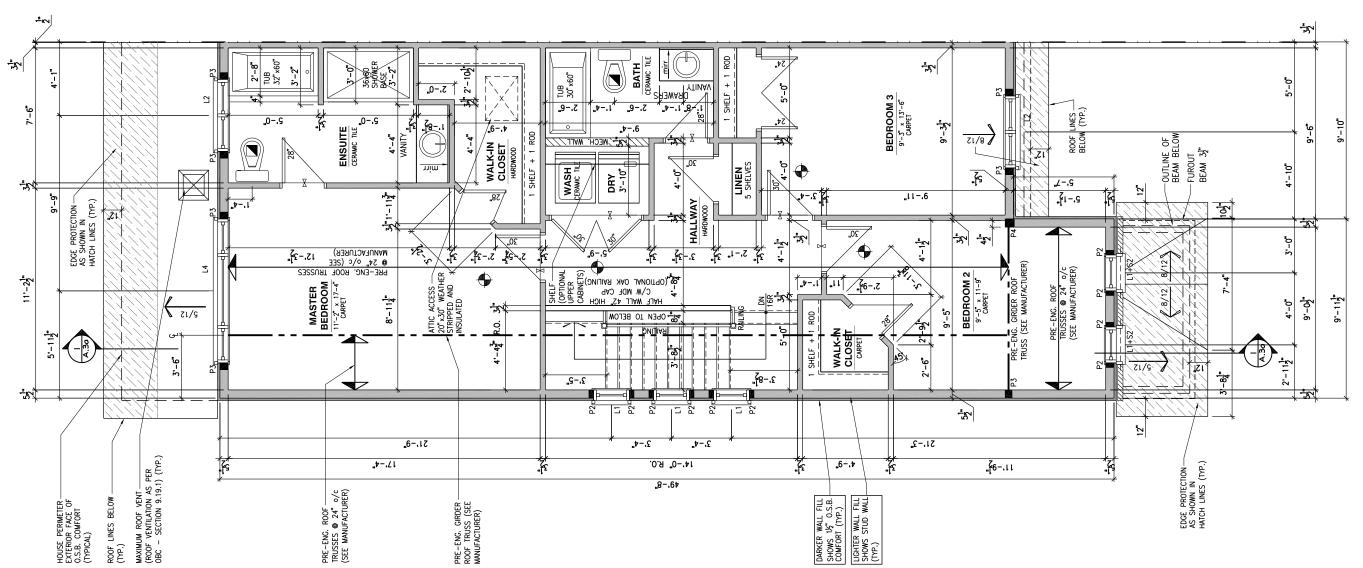

SECOND FLOOR PLAN - OPTIONAL 4 PC ENSUITE - PORCH END UNIT

SCALE: 3/16" = 1'-0"

LOT: **XXXX** DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896
  TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANCES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

# STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10
- $S6 = L 200 \times 100 \times 12$ S7 = L 150x100x10 (8" BEARING)

## LINTEL TABLE:

- L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES
- L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES L4 = 3-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES
- IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

## POST TABLE:

P1 = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-244 OR 2-2x6
P3 = 3-2x4 OR 3-2x6
P4 = 4-2x4 OR 4-2x6
P5 = 5-2x4 OR 5-2x6
P6 = 6-2x4 OR 6-2x6
P13 = HSS R8 0x88 0x 18 x 100x200x12 T&B P1

- P4 = 4-2x4 Or 4-2x0 P5 = 5-2x4 OR 5-2x6 P6 = 6-2x4 OR 6-2x6 P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)
- 13 63 83 89 89 4.8 + 100 200 x12 1 & B PL. (\*) P15 = HSS 89 x89 x4.8 + 100 x200 x12 1 & B PL. (\*) P15 = HSS 76 2 x76 2 x4.78 + 100 x180 x12 1 & B PL. (\*) P16 = HSS 76 2 x76 2 x4.78 + 130 x130 x12 1 & B PL. (\*) P17 = HSS 73 0.0 x4.8 + 100 x180 x12 BOTTOM PL.
- + 130x160x10 TOP PL. (\*) (\*) = 2-120 ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)

• IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

SMOKE ALARMS AS PER SECTION 9.10.19. OF THE
ONTARIO BUILDING CODE:

- SHALL HAVE A VISUAL SIGNALING DEVICE;

- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;

- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND

- CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

# 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

# ORAWING: SECOND FLOOR PLAN **OPT 4PC ENSUITE - PORCH END**

SCALE: 3/16" = 1'-0" xx/xx/xxxx

120 - THE HUNTLEY 2020 FOOTPRINT

A.9b

SHEET

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE FOUNDATION WALL OR SUPPORTING MEMBER
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS



**SECOND FLOOR PLAN - OPTIONAL 5 PC ENSUITE - PORCH END UNIT** 

SCALE: 3/16" = 1'-0"

LOT: **XXXX** DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valegraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611
- •• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM ••

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

### NOTES: STEEL LINTEL:

S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10 S6 = L 200x100x12

S7 = L 150x100x10 (8" BEARING)

#### LINTEL TABLE:

- IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

## POST TABLE:

PT = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAWY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-2x4 OR 2-2x6
P3 = 3-2x4 OR 3-2x6
P4 = 4-2x4 OR 4-2x6
P5 = 5-2x4 OR 5-2x6
P5 = 5-2x4 OR 5-2x6
P13 = HSS 88.9x8.9x3.18 + 100x200x12 T&B PL. (\*)
P14 = HSS 88.9x8.9x3.18 + 100x200x12 T&B PL. (\*)
P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*)
P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*)
P17 = HSS 73 O.D.x4.8 + 100x180x12 BOTTOM PL.
+ 130x160x10 TOP PL. (\*)
(\*) = 2-12e ANCH. (WHERE ANCH. PL. NOT USED)

POST ARE ALL JACK c/w STUD
(EX. P2 = 1 JACK + 1 STUD)
 IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"



SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:

- SHALL HAVE A VISUAL SIGNALING DEVICE;

- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;

- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND

- CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

# 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION		MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

# ORAWING: SECOND FLOOR PLAN

**OPT 5PC ENSUITE - PORCH END** | SCALE: | 3/16" = 1'-0"


120 - THE HUNTLEY

2020 FOOTPRINT (STANDARD DRAWINGS)

SHEET: A.9c

xx/xx/xxxx

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER
  TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS

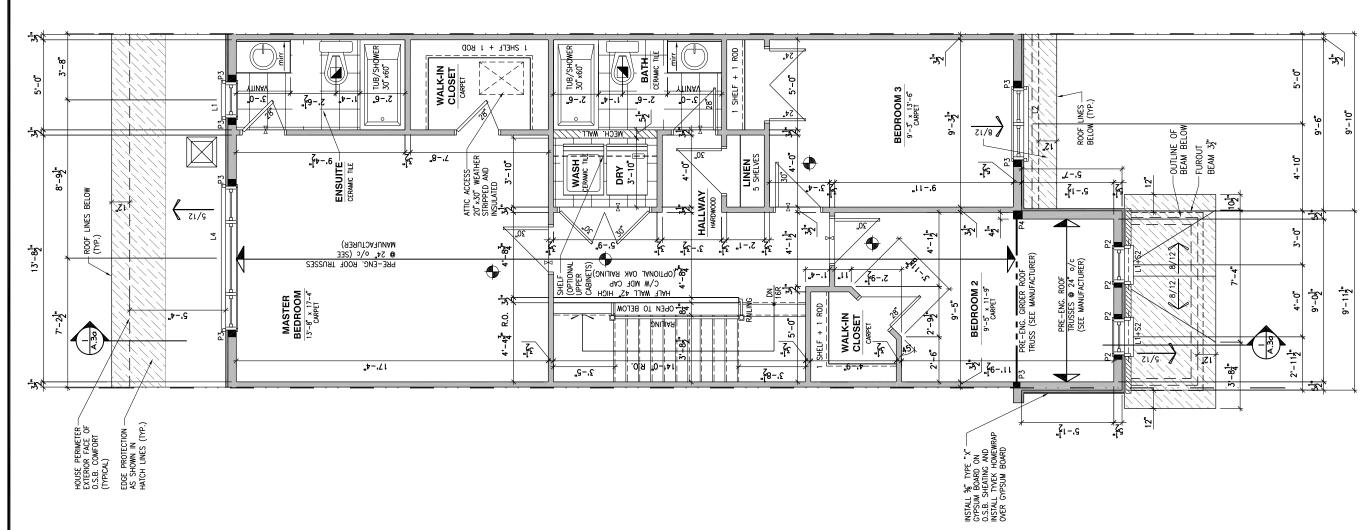

SCALE: 3/16" = 1'-0"

 $\left( A.9d \right)$ 

**SECOND FLOOR PLAN - STANDARD ENSUITE - MID UNIT** 

LOT: XXXX DATE: XX/XX/XXXX



I<u>DANIEL GUERIN</u> ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BCIN #19896
- TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANCES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER
DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING
CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

# STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10 S6 = L 200x100x12
- S7 = L 150x100x10 (8" BEARING)

# LINTEL TABLE:

- L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES
- L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES L4 = 3-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES
- IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

# POST TABLE:

- P1 = 3" ADJUSTABLE STEEL COLUMN
  P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
  POST BY USP
  P2 = 2-244 OR 2-2x6
  P3 = 3-2x4 OR 3-2x6
  P4 = 4-2x4 OR 4-2x6
  P5 = 5-2x4 OR 5-2x6
  P6 = 6-2x4 OR 6-2x6
  P13 = HSS R8 0x88 0x 18 x 100x200x12 T&B P1
- P4 = 4-2x4 Or 4-2x0 P5 = 5-2x4 OR 5-2x6 P6 = 6-2x4 OR 6-2x6 P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)
- 13 63 83 89 89 4.8 + 100 200 x12 1 & B PL. (\*) P15 = HSS 89 x89 x4.8 + 100 x200 x12 1 & B PL. (\*) P15 = HSS 76 2 x76 2 x4.78 + 100 x180 x12 1 & B PL. (\*) P16 = HSS 76 2 x76 2 x4.78 + 130 x130 x12 1 & B PL. (\*) P17 = HSS 73 0.0 x4.8 + 100 x180 x12 BOTTOM PL.
- + 130x160x10 TOP PL. (\*) (\*) = 2-120 ANCH. (WHERE ANCH. PL. NOT USED)

POST ARE ALL JACK c/w STUD
 (EX. P2 = 1 JACK + 1 STUD)
 IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

SMOKE ALARMS AS PER SECTION 9.10.19. OF THE
ONTARIO BUILDING CODE:

- SHALL HAVE A VISUAL SIGNALING DEVICE;

- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;

- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND

- CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

# 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYOR
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

# SECOND FLOOR PLAN **STANDARD ENSUITE - MID**


SCALE: 3/16" = 1'-0" XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT

A.9d

SHEET

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER
  TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS

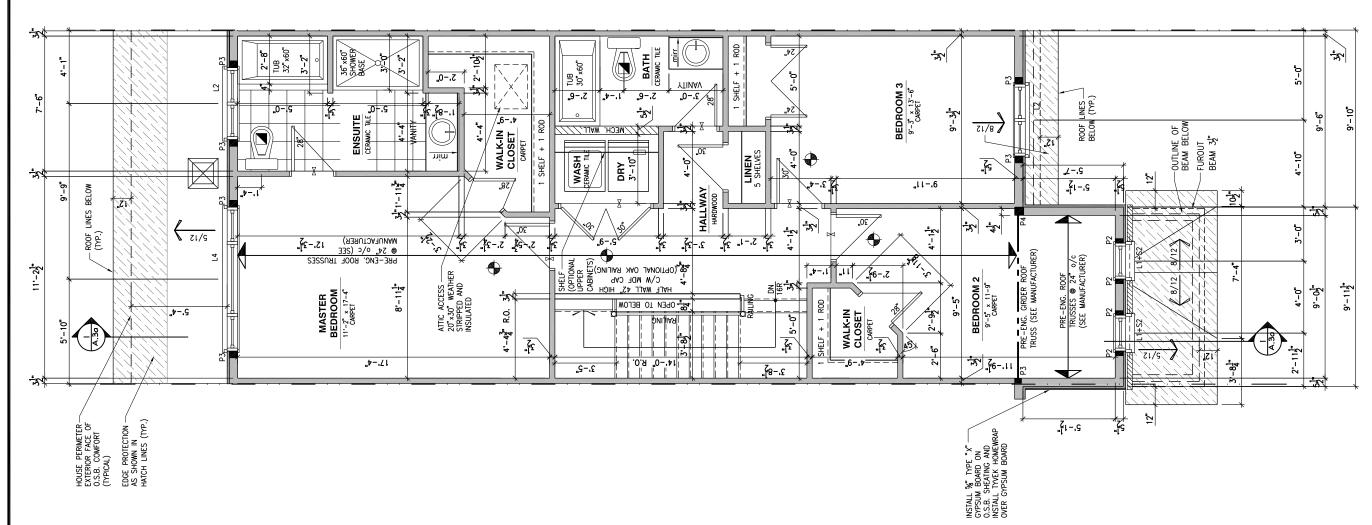

**SECOND FLOOR PLAN - OPTIONAL 4 PC ENSUITE - MID UNIT** 

(A.9e)

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896
- TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANCES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER
DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING
CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

## STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10 S6 = L 200x100x12
- S7 = L 150x100x10 (8" BEARING)

## LINTEL TABLE:

- L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES
- L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES L4 = 3-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES
- IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

## POST TABLE:

- P1 = 3" ADJUSTABLE STEEL COLUMN
  P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
  POST BY USP
  P2 = 2-244 OR 2-2x6
  P3 = 3-2x4 OR 3-2x6
  P4 = 4-2x4 OR 4-2x6
  P5 = 5-2x4 OR 5-2x6
  P6 = 6-2x4 OR 6-2x6
  P13 = HSS R8 0x88 0x 18 x 100x200x12 T&B P1
- P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)
- 13 63 83 89 89 4.8 + 100 200 x12 1 & B PL. (\*) P15 = HSS 89 x89 x4.8 + 100 x200 x12 1 & B PL. (\*) P15 = HSS 76 2 x76 2 x4.78 + 100 x180 x12 1 & B PL. (\*) P16 = HSS 76 2 x76 2 x4.78 + 130 x130 x12 1 & B PL. (\*) P17 = HSS 73 0.0 x4.8 + 100 x180 x12 BOTTOM PL.
- + 130x160x10 TOP PL. (\*) (\*) = 2-120 ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)

• IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

SMOKE ALARMS AS PER SECTION 9.10.19. OF THE
ONTARIO BUILDING CODE:

- SHALL HAVE A VISUAL SIGNALING DEVICE;

- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;

- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND

- CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

# 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

# SECOND FLOOR PLAN **OPT 4 PC ENSUITE - MID**

(STANDARD DRAWINGS)

SCALE: 3/16" = 1'-0"

XX/XX/XXXX SHEET

120 - THE HUNTLEY 2020 FOOTPRINT

A.9e

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE FOUNDATION WALL OR SUPPORTING MEMBER
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS

**SECOND FLOOR PLAN - OPTIONAL 5 PC ENSUITE - MID UNIT** 

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valegraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*\*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

### NOTES: STEEL LINTEL:

S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10 S6 = L 200x100x12

S7 = L 150x100x10 (8" BEARING)

#### LINTEL TABLE:

- IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

## POST TABLE:

PT = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAWY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-2x4 OR 2-2x6
P3 = 3-2x4 OR 3-2x6
P4 = 4-2x4 OR 4-2x6
P5 = 5-2x4 OR 5-2x6
P5 = 5-2x4 OR 5-2x6
P13 = HSS 88.9x8.9x3.18 + 100x200x12 T&B PL. (\*)
P14 = HSS 88.9x8.9x3.18 + 100x200x12 T&B PL. (\*)
P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*)
P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*)
P17 = HSS 73 O.D.x4.8 + 100x180x12 BOTTOM PL.
+ 130x160x10 TOP PL. (\*)
(\*) = 2-12e ANCH. (WHERE ANCH. PL. NOT USED)

POST ARE ALL JACK c/w STUD
(EX. P2 = 1 JACK + 1 STUD)
 IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:

- SHALL HAVE A VISUAL SIGNALING DEVICE;

- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;

- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND

- CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

# 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

# SECOND FLOOR PLAN **OPT 5 PC ENSUITE - MID**


SCALE: 3/16" = 1'-0"

xx/xx/xxxx SHEET: 120 - THE HUNTLEY

**A.9f** 

2020 FOOTPRINT

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER
  TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS

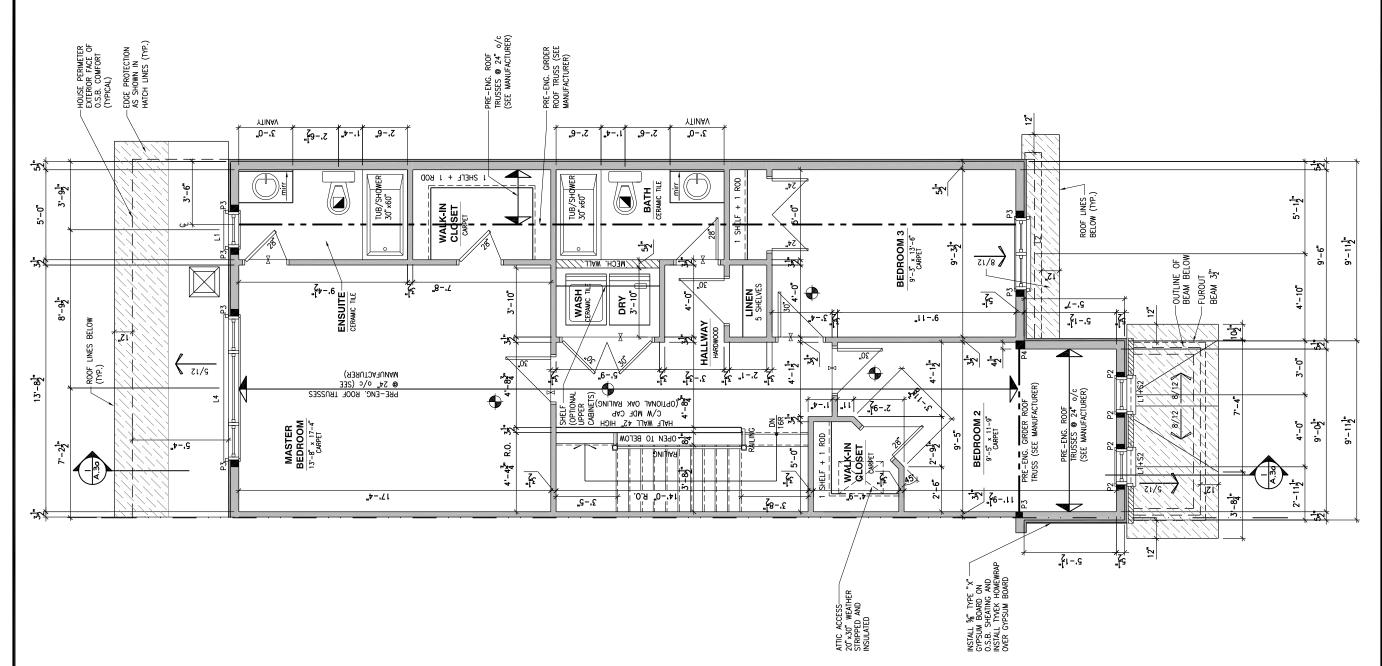

**SECOND FLOOR PLAN - STANDARD ENSUITE - GARAGE END UNIT** 

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896
- TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANCES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

### NOTES: STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10
- $S6 = L 200 \times 100 \times 12$ S7 = L 150x100x10 (8" BEARING)

## INTEL TABLE:

- L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES
- L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES L4 = 3-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES
- $\bullet$  IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

## POST TABLE:

- P1 = 3" ADJUSTABLE STEEL COLUMN
  P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
  POST BY USP
  P2 = 2-244 OR 2-2x6
  P3 = 3-2x4 OR 3-2x6
  P4 = 4-2x4 OR 4-2x6
  P5 = 5-2x4 OR 5-2x6
  P6 = 6-2x4 OR 6-2x6
  P13 = USS R8 0x88 0x 18 x 100x200x12 T&B P1

- P4 = 4-2x4 Or 4-2x0 P5 = 5-2x4 OR 5-2x6 P6 = 6-2x4 OR 6-2x6 P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)
- 13 63 83 83 89 4.8 + 100 200 x12 1 & B PL. (\*) P15 = HSS 83 x89 x4.8 + 100 x200 x12 1 & B PL. (\*) P15 = HSS 76 2 x76 2 x4.78 + 100 x180 x12 1 & B PL. (\*) P16 = HSS 76 2 x76 2 x4.78 + 130 x130 x12 1 & B PL. (\*) P17 = HSS 73 0.0 x4.8 + 100 x180 x12 BOTTOM PL.
- + 130×160×10 TOP PL. (\*) (\*) = 2-120 ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)

• IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

= SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
- SHALL HAVE A VISUAL SIGNALING DEVICE;
- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;
- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;
- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING

POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND — CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

# 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYO
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

# DRAWING: SECOND FLOOR PLAN

STANDARD ENSUITE-GARAGE END


SCALE: 3/16" = 1'-0" 120 - THE HUNTLEY

2020 FOOTPRINT

SHEET **A.**9g

XX/XX/XXXX

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER
  TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS

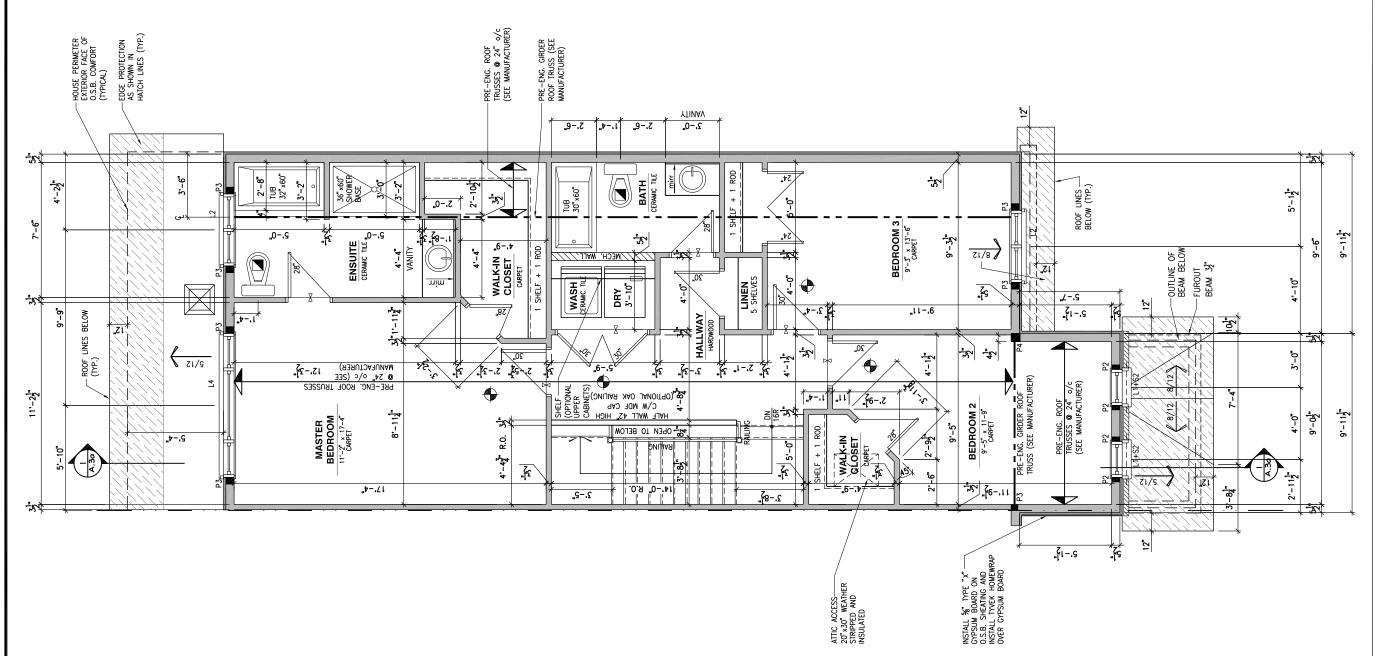

SECOND FLOOR PLAN - OPTIONAL 4 PC ENSUITE - GARAGE END UNIT

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANCES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

# STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10
- $S6 = L 200 \times 100 \times 12$ S7 = L 150x100x10 (8" BEARING)

## LINTEL TABLE:

- L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES
- L3 = 2-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES L4 = 3-1.75x9.5 LVL (1.9E) + P3 ON BOTH SIDES
- IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

## POST TABLE:

- P1 = 3" ADJUSTABLE STEEL COLUMN
  P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
  POST BY USP
  P2 = 2-244 OR 2-2x6
  P3 = 3-2x4 OR 3-2x6
  P4 = 4-2x4 OR 4-2x6
  P5 = 5-2x4 OR 5-2x6
  P6 = 6-2x4 OR 6-2x6
  P13 = HSS R8 0x88 0x 18 x 100x200x12 T&B P1
- P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (\*)
- 13 63 83 89 89 4.8 + 100 200 x12 1 & B PL. (\*) P15 = HSS 89 x89 x4.8 + 100 x200 x12 1 & B PL. (\*) P15 = HSS 76 2 x76 2 x4.78 + 100 x180 x12 1 & B PL. (\*) P16 = HSS 76 2 x76 2 x4.78 + 130 x130 x12 1 & B PL. (\*) P17 = HSS 73 0.0 x4.8 + 100 x180 x12 BOTTOM PL.
- + 130×160×10 TOP PL. (\*)

  (\*) = 2-120 ANCH. (WHERE ANCH. PL. NOT USED)

\* POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)

• IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

SMOKE ALARMS AS PER SECTION 9.10.19. OF THE
ONTARIO BUILDING CODE:

- SHALL HAVE A VISUAL SIGNALING DEVICE;

- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;

- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND

- CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

# 2012 O.B.C. DRAWINGS

l		ļ	
REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

# DRAWING: SECOND FLOOR PLAN

OPT 4PC ENSUITE - GARAGE END SCALE: 3/16" = 1'-0"

120 - THE HUNTLEY 2020 FOOTPRINT

(STANDARD DRAWINGS)

A.9h

XX/XX/XXXX

SHEET

- 1- ALL POINT LOADS TO BE BLOCKED DOWN TO THE FOUNDATION WALL OR SUPPORTING MEMBER
- 2- ALL BEAMS TO HAVE A MIN 3 1/2" END BEARING
- 3- COORDINATE COLUMNS WITH FINAL LOCATION OF GIRDER TRUSSES AS PER APPROVED ROOF TRUSS SHOP DRAWINGS

**SECOND FLOOR PLAN - OPTIONAL 5 PC ENSUITE - GARAGE END UNIT** 

SCALE: 3/16" = 1'-0"

LOT: **XXXX** DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valegraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*\*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

### NOTES: STEEL LINTEL:

S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10 S6 = L 200x100x12

S7 = L 150x100x10 (8" BEARING)

#### LINTEL TABLE:

- IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

# POST TABLE:

PT = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAWY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-2x4 OR 2-2x6
P3 = 3-2x4 OR 3-2x6
P4 = 4-2x4 OR 4-2x6
P5 = 5-2x4 OR 5-2x6
P5 = 5-2x4 OR 5-2x6
P13 = HSS 88.9x8.9x3.18 + 100x200x12 T&B PL. (\*)
P14 = HSS 88.9x8.9x3.18 + 100x200x12 T&B PL. (\*)
P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (\*)
P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (\*)
P17 = HSS 73 O.D.x4.8 + 100x180x12 BOTTOM PL.
+ 130x160x10 TOP PL. (\*)
(\*) = 2-12e ANCH. (WHERE ANCH. PL. NOT USED)

POST ARE ALL JACK c/w STUD
(EX. P2 = 1 JACK + 1 STUD)
 IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:

- SHALL HAVE A VISUAL SIGNALING DEVICE;

- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;

- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND

- CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

# 2012 O.B.C. DRAWINGS

l			
REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

# DRAWING: SECOND FLOOR PLAN

# OPT 5PC ENSUITE - GARAGE END


| SCALE: | 3/16" = 1'-0" xx/xx/xxxx

120 - THE HUNTLEY 2020 FOOTPRINT

(STANDARD DRAWINGS)

**A.9i** 

SHEET:

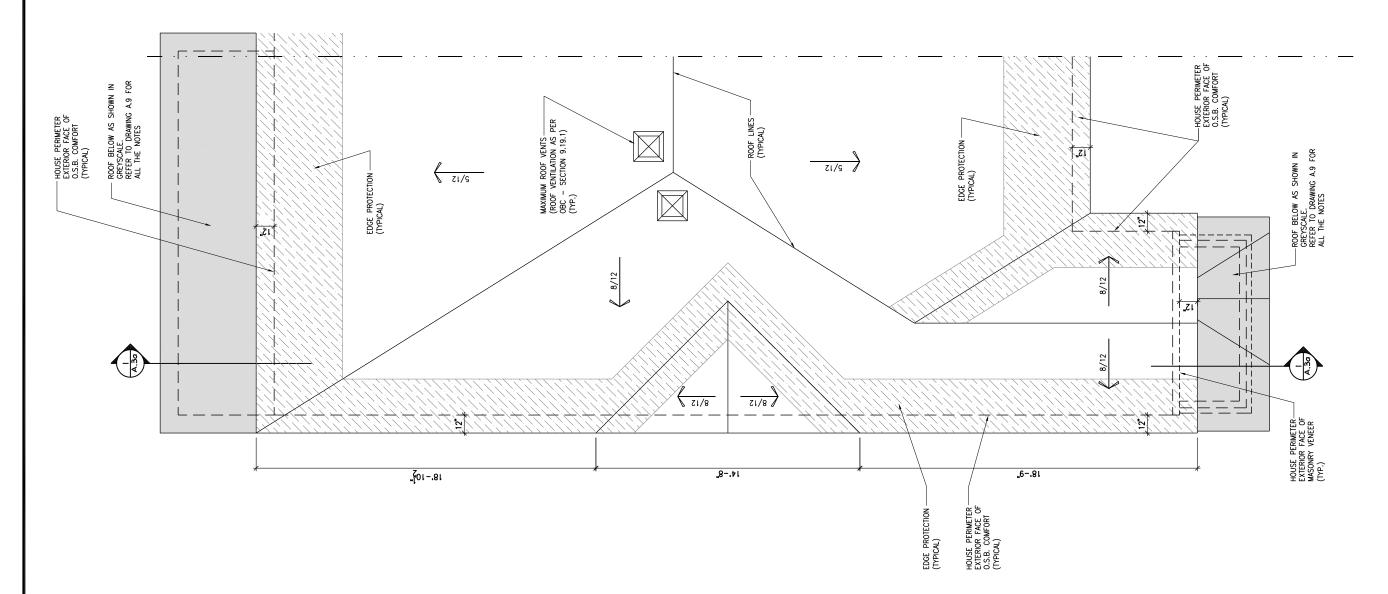

**ROOF PLAN - PORCH END UNIT** 

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valegraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE
B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES
DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW
ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS
ALTOSETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING
DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

# 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VΗ
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY


(STANDARD DRAWINGS)

ROOF PLAN - PORCH END UNIT

| SCALE: | 3/16" = 1'-0" DATE: XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT

SHEET: A.10a

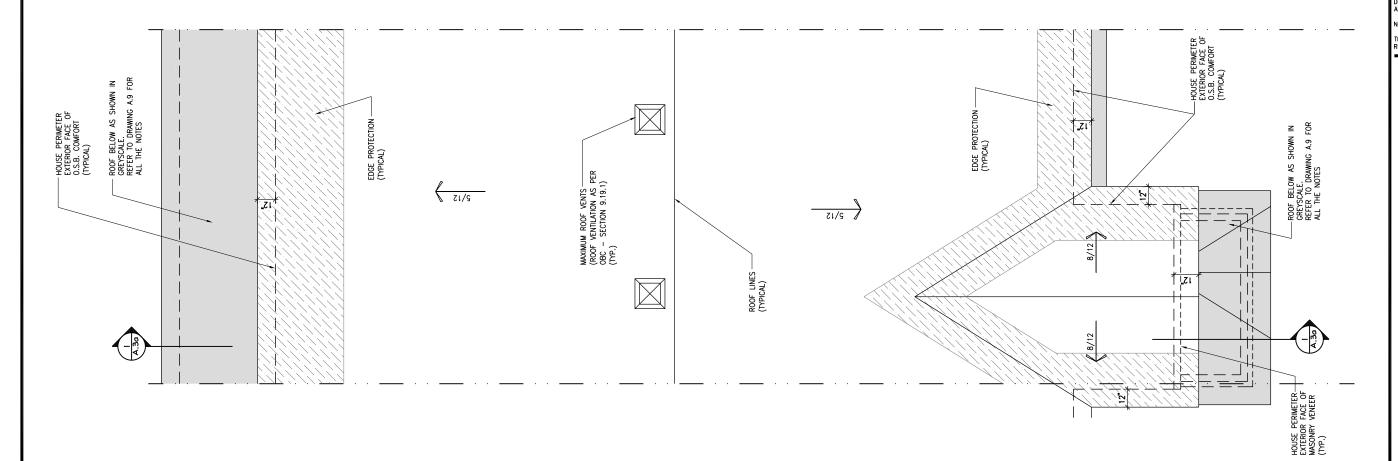

**ROOF PLAN - MID UNIT** SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX

Valecraft Homes (2019) Limited

I<u>DANIEL GUERIN</u>, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE
B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES
DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW
ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS
ALTOSETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING
DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO	DESCRIPTION	MM/DD/YYYY	RY


**ROOF PLAN - MID UNIT** 

| SCALE: | 3/16" = 1'-0" DATE: XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT

(STANDARD DRAWINGS)

SHEET: A.10b

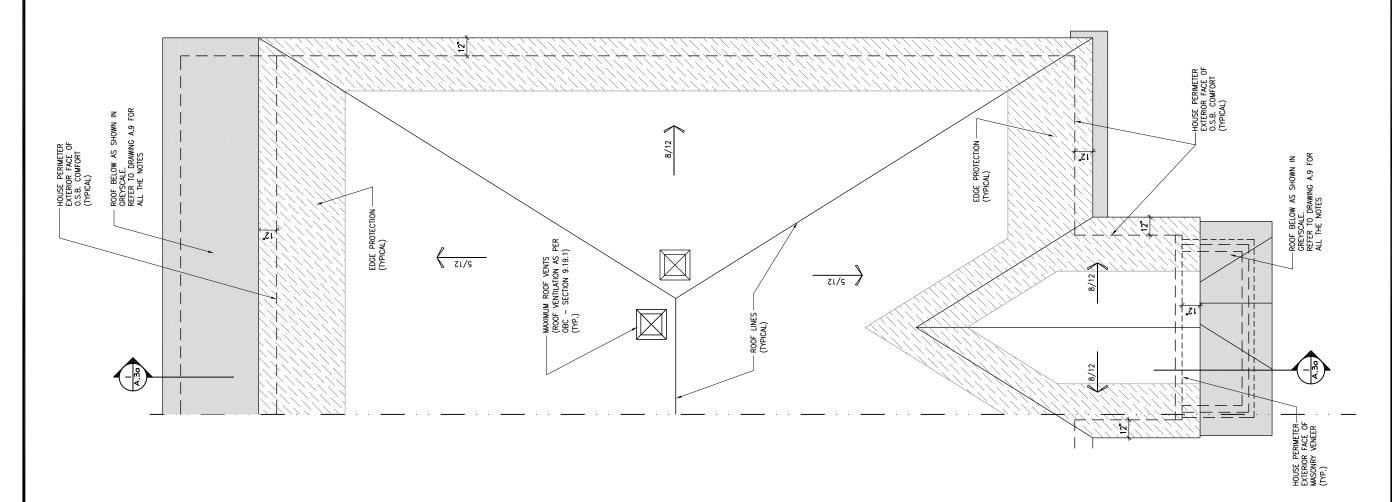

SCALE: 3/16" = 1'-0"

**ROOF PLAN - GARAGE END UNIT** 

LOT: XXXX DATE: XX/XX/XXXX

Valecraft Homes (2019) Limited

I<u>, Daniel Guerin</u>, architectural manager for Valegraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

PERSONAL BCIN #19896
TARION REGISTRATION NUMBER #611

•• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM ••

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE
B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES
DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW
ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS
ALTOSETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING
DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.C. DRAWING	S
---------------------	---

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY


ROOF PLAN - GARAGE END UNIT

| SCALE: | 3/16" = 1'-0" DATE: XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT

(STANDARD DRAWINGS)

SHEET: A.10c

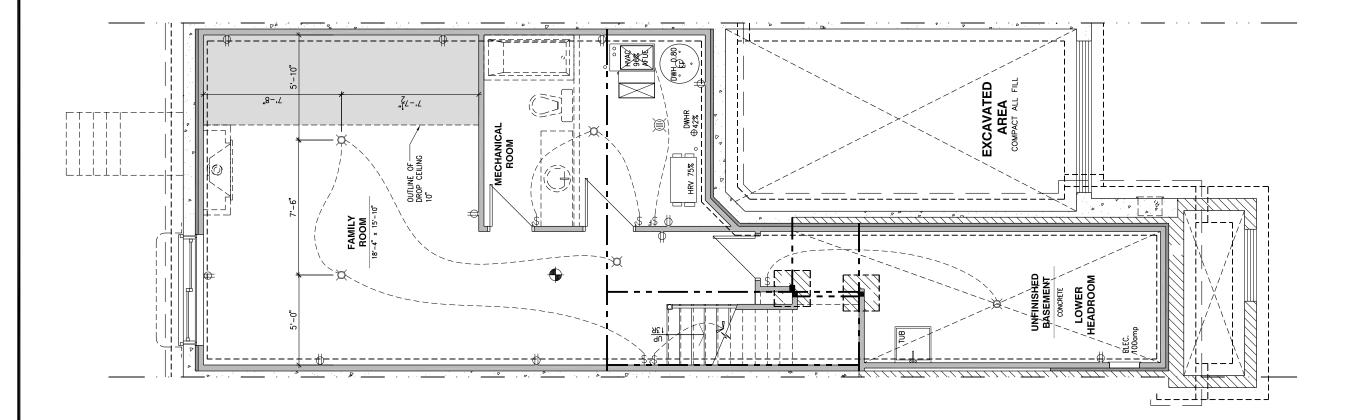

E.la

**ELECTRICAL PLAN - BASEMENT** 

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896
  TARION REGISTRATION NUMBER #611
- SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

- \$ SINGLE POLE SWITCH
- \$3 3 WAY SWITCH
- \$4 4 WAY SWITCH
- \$F FURNACE SWITCH
- \$FP FIREPLACE SWITCH
- DUPLEX OUTLET (12" HIGH)
- DUPLEX OUTLET (UPPER HALF SWITCH)
- GROUND FAULT INTERVOLT
- WP WEATHER PROOF DUPLEX OUTLET



- 220 VOLT OUTLET
- WALL MOUNTED LIGHT FIXTURE
- CEILING MOUNTED LIGHT FIXTURE
- POT LIGHT



- SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
   SHALL HAVE A VISUAL SIGNALING DEVICE;
   ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;
   ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND
   CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.
- = PROVIDE MECHANICAL EXHAUST TO OUTSIDE

# 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

# **ELECTRICAL PLAN BASEMENT**


SCALE: 3/16" = 1'-0" DATE: XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT

(STANDARD DRAWINGS)

E.1a

SHEET

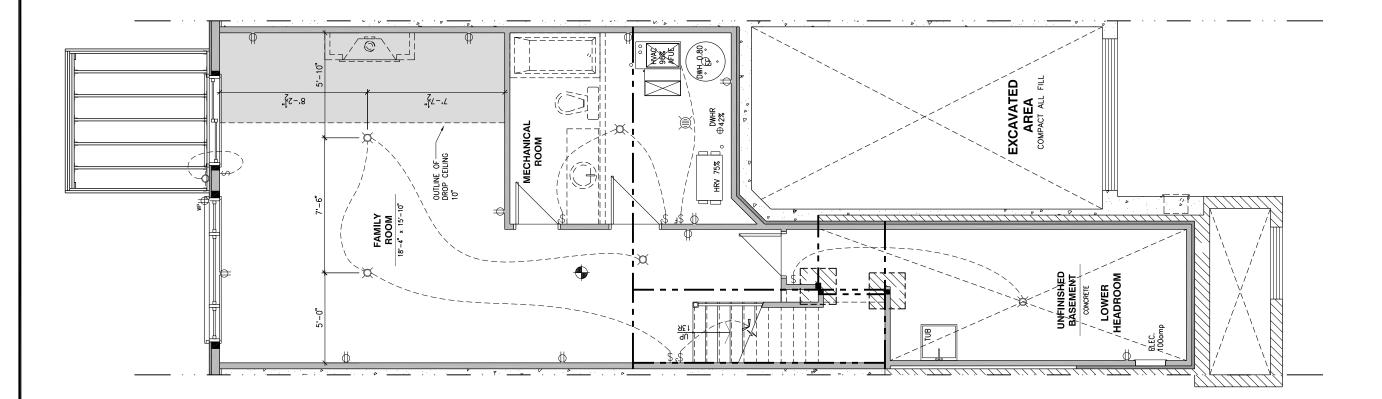

**ELECTRICAL PLAN - BASEMENT - WALKOUT** 

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>DANIEL GUERIN</u> ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611
- •• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

\$ SINGLE POLE SWITCH

\$3 3 WAY SWITCH

\$4 4 WAY SWITCH

\$F FURNACE SWITCH

\$FP FIREPLACE SWITCH

DUPLEX OUTLET (12" HIGH)

DUPLEX OUTLET (UPPER HALF SWITCH)

GROUND FAULT INTERVOLT

WP WEATHER PROOF DUPLEX OUTLET

SPLIT OUTLET

220 VOLT OUTLET

- WALL MOUNTED LIGHT FIXTURE

CEILING MOUNTED LIGHT FIXTURE

POT LIGHT

- SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
  SHALL HAVE A VISUAL SIGNALING DEVICE:
  ARE REGUIRED IN EACH SLEEPING ROOM AND HALLWAY:
  ARE REGUIRED ON EACH STOREY, INCLUDING BASEMENT;
  ARE REGUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM: AND
  CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.
- PROVIDE MECHANICAL EXHAUST TO OUTSIDE

2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VΗ
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

**ELECTRICAL PLAN** 


**BASEMENT - WALKOUT** SCALE: 3/16" = 1'-0"

120 - THE HUNTLEY 2020 FOOTPRINT

E.1b

xx/xx/xxxx

SHEET:

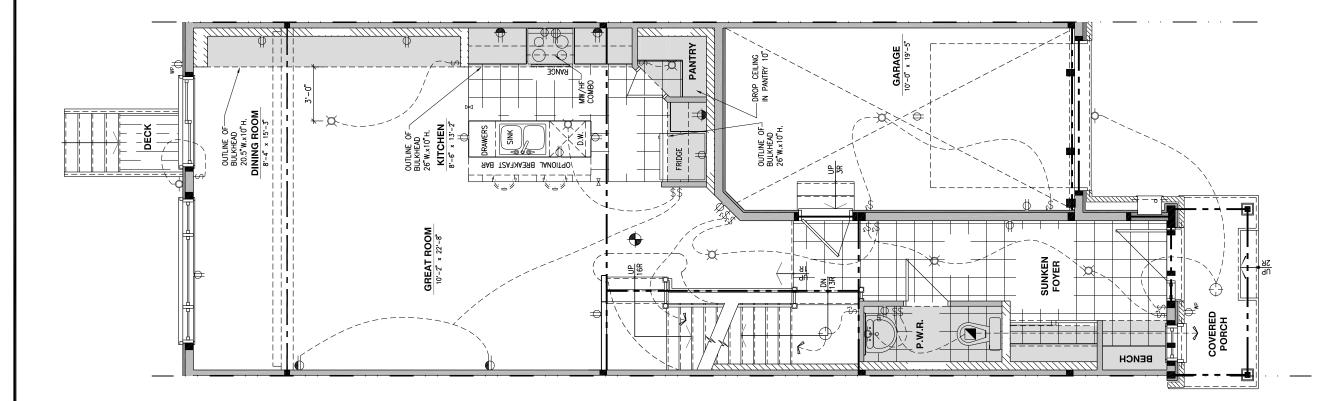

E.2a /

**ELECTRICAL PLAN - GROUND FLOOR - STANDARD KITCHEN** 

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611
- •• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

- \$ SINGLE POLE SWITCH
- \$3 3 WAY SWITCH
- \$4 4 WAY SWITCH
- \$F FURNACE SWITCH
- \$FP FIREPLACE SWITCH
- DUPLEX OUTLET (12" HIGH)
- DUPLEX OUTLET (UPPER HALF SWITCH)
- GROUND FAULT INTERVOLT
- WP WEATHER PROOF DUPLEX OUTLET
- SPLIT OUTLET
- 220 VOLT OUTLET
- WALL MOUNTED LIGHT FIXTURE
- CEILING MOUNTED LIGHT FIXTURE
- POT LICHT



- SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
   SHALL HAVE A VISUAL SIGNALING DEVICE;
   ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;
   ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;
   ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND
   CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.
- = PROVIDE MECHANICAL EXHAUST TO OUTSIDE

# 2012 O.B.C. DRAWINGS


REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VΗ
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

**ELECTRICAL PLAN GROUND FLOOR** 

SCALE: 3/16" = 1'-0" xx/xx/xxxx SHEET:

120 - THE HUNTLEY 2020 FOOTPRINT

E.2a

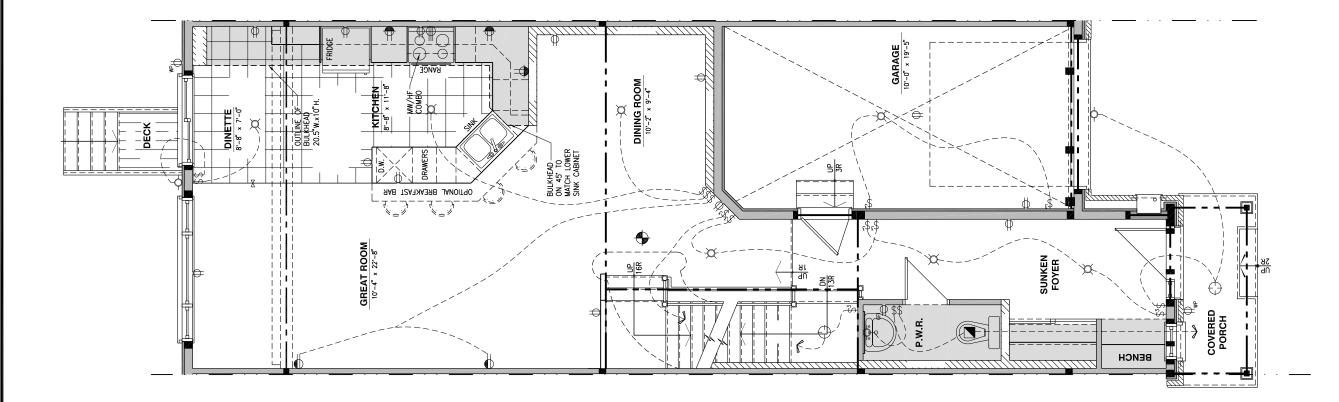

E.2b/

**ELECTRICAL PLAN - GROUND FLOOR - OPTIONAL KITCHEN 1** 

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>DANIEL GUERIN</u> ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611
- •• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

- \$ SINGLE POLE SWITCH
- \$3 3 WAY SWITCH
- \$4 4 WAY SWITCH
- \$F FURNACE SWITCH
- \$FP FIREPLACE SWITCH
- DUPLEX OUTLET (12" HIGH)
- DUPLEX OUTLET (UPPER HALF SWITCH)
- GROUND FAULT INTERVOLT
- WP WEATHER PROOF DUPLEX OUTLET



220 VOLT OUTLET


- WALL MOUNTED LIGHT FIXTURE

CEILING MOUNTED LIGHT FIXTURE

POT LICHT



- SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
   SHALL HAVE A VISUAL SIGNALING DEVICE;
   ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;
   ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;
   ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND
   CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.



# 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VΗ
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VΗ
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY


# ELECTRICAL PLAN

**GROUND FLOOR** 

SCALE: 3/16" = 1'-0" 120 - THE HUNTLEY 2020 FOOTPRINT

SHEET: E.2b

xx/xx/xxxx

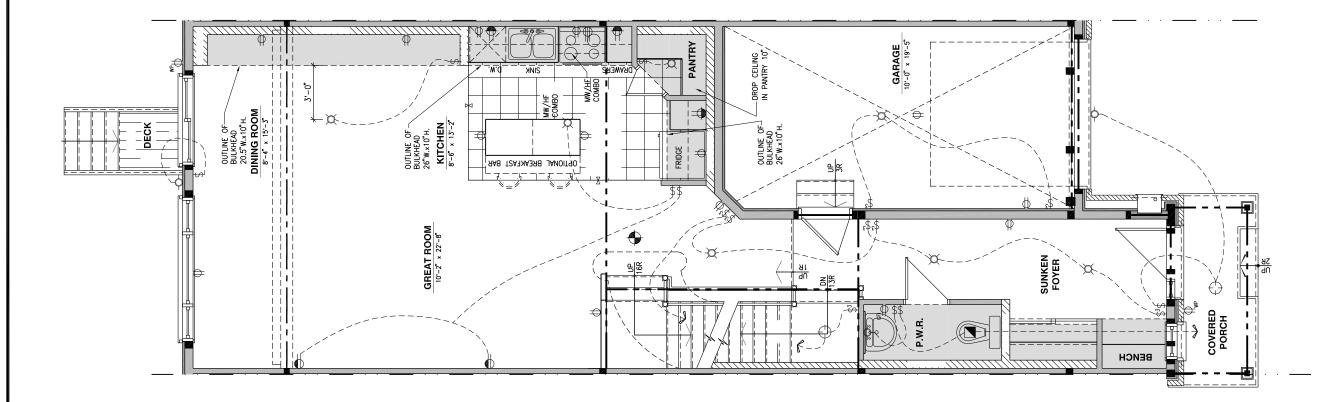

E.2c

**ELECTRICAL PLAN - GROUND FLOOR - OPTIONAL KITCHEN 2** 

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611
- SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. DOCUMENT


ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.


NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

- \$ SINGLE POLE SWITCH
- \$3 3 WAY SWITCH
- \$4 4 WAY SWITCH
- \$F FURNACE SWITCH
- \$FP FIREPLACE SWITCH
- DUPLEX OUTLET (12" HIGH)
- DUPLEX OUTLET (UPPER HALF SWITCH)
- GROUND FAULT INTERVOLT
- WP WEATHER PROOF DUPLEX OUTLET
- SPLIT OUTLET
- 220 VOLT OUTLET
- WALL MOUNTED LIGHT FIXTURE
- CEILING MOUNTED LIGHT FIXTURE
- POT LIGHT



- SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
  SHALL HAVE A VISUAL SIGNALING DEVICE;
  ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;
  ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND
  CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.



# 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VΗ
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

**ELECTRICAL PLAN GROUND FLOOR** 


SCALE: 3/16" = 1'-0" DATE: XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT

(STANDARD DRAWINGS)

E.2c

SHEET:

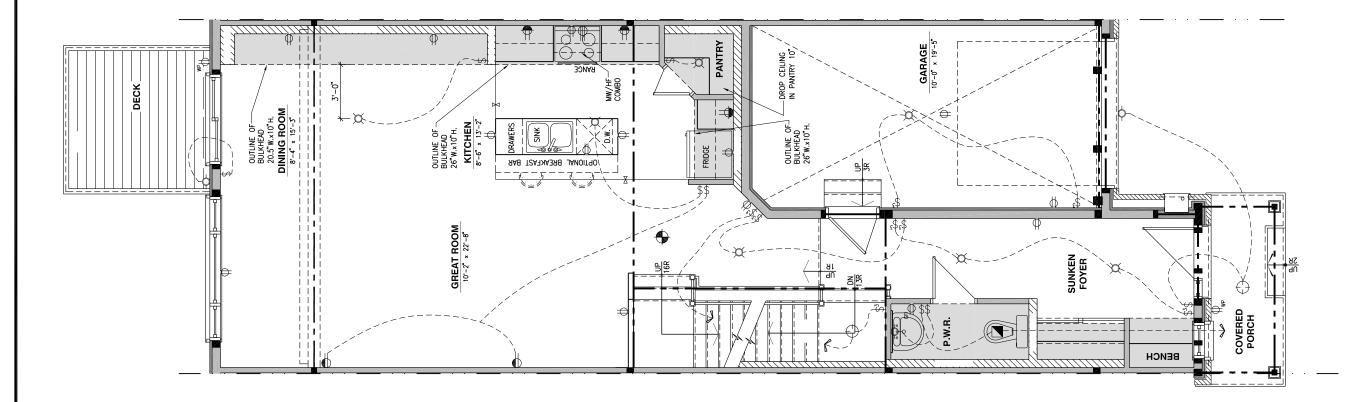

E.2d/

**ELECTRICAL PLAN - GROUND FLOOR - STANDARD KITCHEN - WALKOUT** 

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611
- •• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

- \$ SINGLE POLE SWITCH
- \$3 3 WAY SWITCH
- \$4 4 WAY SWITCH
- \$F FURNACE SWITCH
- \$FP FIREPLACE SWITCH
- DUPLEX OUTLET (12" HIGH)
- DUPLEX OUTLET (UPPER HALF SWITCH)
- GROUND FAULT INTERVOLT
- WP WEATHER PROOF DUPLEX OUTLET



- 220 VOLT OUTLET
- WALL MOUNTED LIGHT FIXTURE
- CEILING MOUNTED LIGHT FIXTURE
- POT LICHT
- SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:

  SHALL HAVE A VISUAL SIGNALING DEVICE;

  ARE REQUIRED IN EACH SILEPING ROOM AND HALLWAY;

  ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

  ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND

  CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.
- = PROVIDE MECHANICAL EXHAUST TO OUTSIDE

# 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VΗ
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY

**ELECTRICAL PLAN GROUND FLOOR** 


SCALE: 3/16" = 1'-0"

120 - THE HUNTLEY 2020 FOOTPRINT

E.2d

xx/xx/xxxx

SHEET:

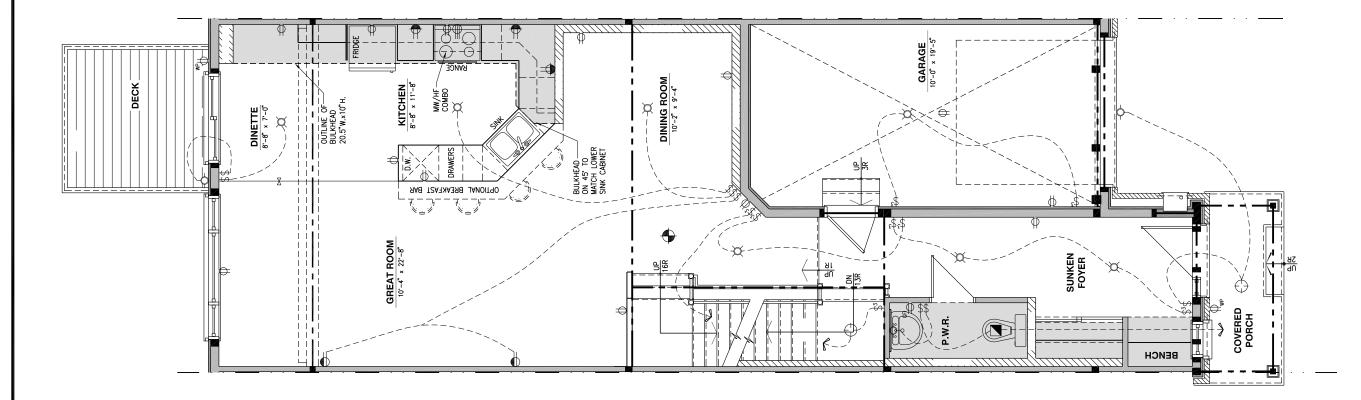

E.2e

**ELECTRICAL PLAN - GROUND FLOOR - OPTIONAL KITCHEN 1 - WALKOUT** 

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX

Homes (2019) Limited

I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611
- SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

- \$ SINGLE POLE SWITCH
- \$3 3 WAY SWITCH
- \$4 4 WAY SWITCH
- \$F FURNACE SWITCH
- \$FP FIREPLACE SWITCH
- DUPLEX OUTLET (12" HIGH)
- DUPLEX OUTLET (UPPER HALF SWITCH)
- GROUND FAULT INTERVOLT
- WP WEATHER PROOF DUPLEX OUTLET



- 220 VOLT OUTLET
- WALL MOUNTED LIGHT FIXTURE
- CEILING MOUNTED LIGHT FIXTURE
- POT LIGHT



- SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
  SHALL HAVE A VISUAL SIGNALING DEVICE;
  ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;
  ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND
  CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.
- = PROVIDE MECHANICAL EXHAUST TO OUTSIDE

# 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION		MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY


# **ELECTRICAL PLAN**

**GROUND FLOOR** 

SCALE: 3/16" = 1'-0" 120 - THE HUNTLEY 2020 FOOTPRINT

SHEET: E.2e

DATE: XX/XX/XXXX

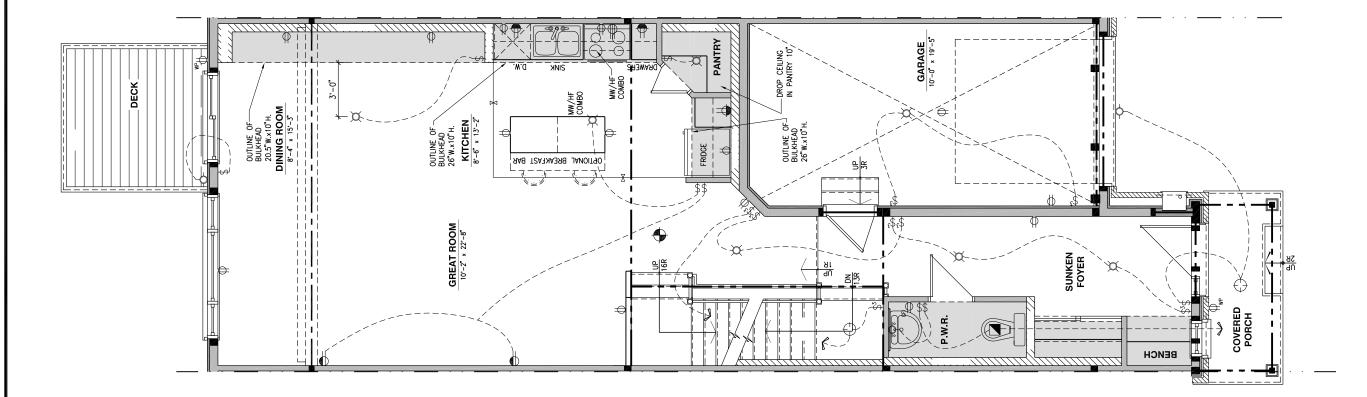

**ELECTRICAL PLAN - GROUND FLOOR - OPTIONAL KITCHEN 2 - WALKOUT** 

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>, Daniel Guerin</u>, architectural manager for Valecraft Homes Ltd., have reviewed the following documents and take responsibility for the design activities.

- PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611
- SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

- \$ SINGLE POLE SWITCH
- \$3 3 WAY SWITCH
- \$4 4 WAY SWITCH
- \$F FURNACE SWITCH
- \$FP FIREPLACE SWITCH
- DUPLEX OUTLET (12" HIGH)
- DUPLEX OUTLET (UPPER HALF SWITCH)
- GROUND FAULT INTERVOLT
- weather proof duplex outlet



- 220 VOLT OUTLET
- WALL MOUNTED LIGHT FIXTURE
- CEILING MOUNTED LIGHT FIXTURE
- POT LIGHT



- SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
  SHALL HAVE A VISUAL SIGNALING DEVICE;
  ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;
  ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND
  CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.
- = PROVIDE MECHANICAL EXHAUST TO OUTSIDE

# 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VΗ
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	
NO.	DESCRIPTION	MM/DD/YYYY	BY


# ELECTRICAL PLAN

**GROUND FLOOR** 

SCALE: 3/16" = 1'-0" 120 - THE HUNTLEY 2020 FOOTPRINT

SHEET: **E.2f** 

xx/xx/xxxx

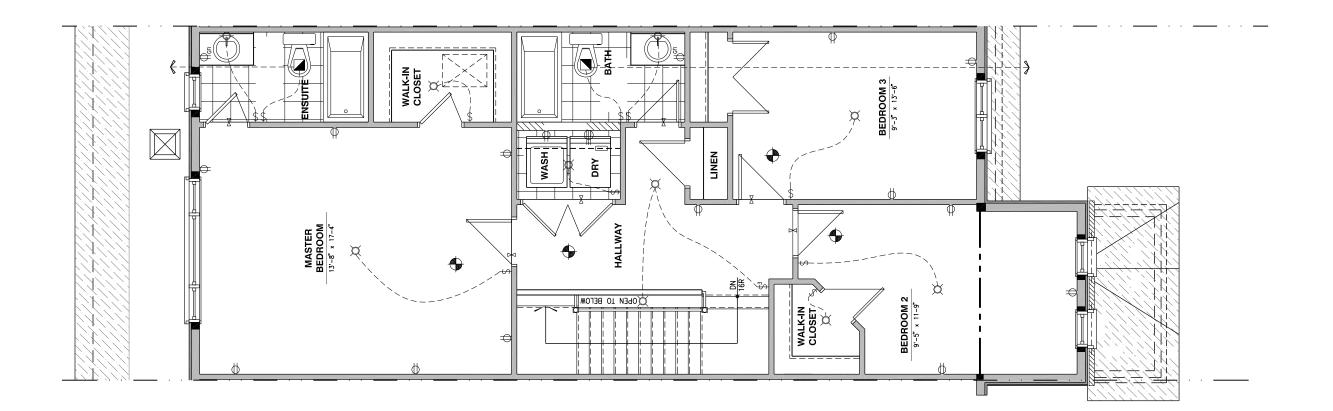



**ELECTRICAL PLAN - SECOND FLOOR - STANDARD ENSUITE** 

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX

Homes (2019) Limited

I<u>, Daniel Guerin</u>, architectural manager for Valecraft homes Ltd., have reviewed the following documents and take responsibility for the design activities.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

•• SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM ••

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

\$ SINGLE POLE SWITCH

\$3 3 WAY SWITCH

\$4 4 WAY SWITCH

\$F FURNACE SWITCH

\$FP FIREPLACE SWITCH

DUPLEX OUTLET (12" HIGH)

DUPLEX OUTLET (UPPER HALF SWITCH)

GROUND FAULT INTERVOLT

WP WEATHER PROOF DUPLEX OUTLET



220 VOLT OUTLET

- WALL MOUNTED LIGHT FIXTURE

CEILING MOUNTED LIGHT FIXTURE

POT LIGHT



SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:

SHALL HAVE A VISUAL SIGNALING DEVICE;

ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;

ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND

CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

# 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VH
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY


# **ELECTRICAL PLAN SECOND FLOOR**

(STANDARD DRAWINGS)

SCALE: 3/16" = 1'-0" xx/xx/xxxx

120 - THE HUNTLEY 2020 FOOTPRINT

SHEET: **E.**3a

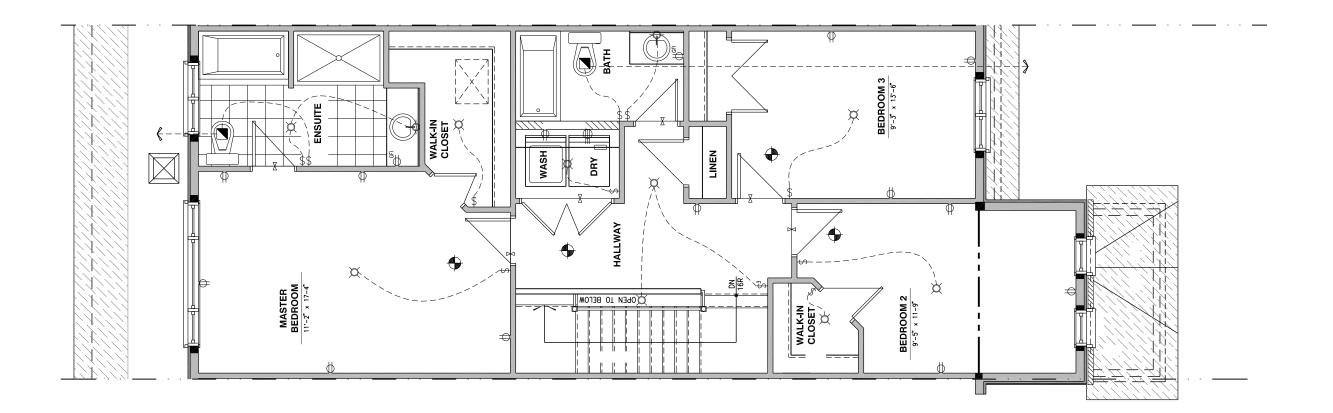

(E.3b)

**ELECTRICAL PLAN - SECOND FLOOR - OPTIONAL 4 PC ENSUITE** 

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>DANIEL GUERIN</u> ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BCIN #19896
  TARION REGISTRATION NUMBER #611
- SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM •

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. DOCUMENT

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

- \$ SINGLE POLE SWITCH
- \$3 3 WAY SWITCH
- \$4 4 WAY SWITCH
- \$F FURNACE SWITCH
- \$FP FIREPLACE SWITCH
- DUPLEX OUTLET (12" HIGH)
- DUPLEX OUTLET (UPPER HALF SWITCH)
- GROUND FAULT INTERVOLT
- WP WEATHER PROOF DUPLEX OUTLET



220 VOLT OUTLET

- WALL MOUNTED LIGHT FIXTURE

CEILING MOUNTED LIGHT FIXTURE

POT LIGHT



- SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
  SHALL HAVE A VISUAL SIGNALING DEVICE;
  ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;
  ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND
  CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.
- = PROVIDE MECHANICAL EXHAUST TO OUTSIDE

# 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VΗ
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VH
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

# **ELECTRICAL PLAN SECOND FLOOR**

SCALE: 3/16" = 1'-0" DATE: XX/XX/XXXX

120 - THE HUNTLEY 2020 FOOTPRINT

E.3b

SHEET:

**ELECTRICAL PLAN - SECOND FLOOR - OPTIONAL 5 PC ENSUITE** 

SCALE: 3/16" = 1'-0"

LOT: XXXX DATE: XX/XX/XXXX



I<u>DANIEL GUERIN</u> ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611
- \*\* SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM \*\*

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

- \$ SINGLE POLE SWITCH
- \$3 3 WAY SWITCH
- \$4 4 WAY SWITCH
- \$F FURNACE SWITCH
- \$FP FIREPLACE SWITCH
- DUPLEX OUTLET (12" HIGH)
- DUPLEX OUTLET (UPPER HALF SWITCH) GROUND FAULT INTERVOLT
- WP WEATHER PROOF DUPLEX OUTLET
- SPLIT OUTLET
- 220 VOLT OUTLET
- WALL MOUNTED LIGHT FIXTURE
- CEILING MOUNTED LIGHT FIXTURE
- POT LIGHT



- SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:

   SHALL HAVE A VISUAL SIGNALING DEVICE;

   ARE RECOURED IN EACH SILEEPING ROOM AND HALLWAY;

   ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

   ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND

   CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

# 2012 O.B.C. DRAWINGS

REV-4	NEW STANDARD DRWG MODIFICATION	01/01/2021	DOYON
REV-3	AS PER STRUCTURAL REVIEW	03/20/2019	VΗ
REV-2	AS PER STRUCTURAL REVIEW	11/07/2018	VΗ
REV-1	NEW STANDARD DRWG MODIFICATION	11/13/2017	MAD
NO.	DESCRIPTION	MM/DD/YYYY	BY

**ELECTRICAL PLAN** SECOND FLOOR

SCALE: 3/16" = 1'-0" xx/xx/xxxx

120 - THE HUNTLEY 2020 FOOTPRINT

SHEET: E.3c