

ELEVATION A - FRONT

LOT: 4 - PST PH. 5 DATE: 10/29/2020



I, MARC-ANDRE DECOEUR, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BCIN #44555
 TARION REGISTRATION NUMBER #611
- ** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM *

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

- B BRICK (MAIN)

- -20 BRICK 20mm RECESSED S SIDING (HORIZONTAL) ST STONE VENEER T TRIM 200mm COVE SIDING AF ALUMINUM FASCIA AC ALUMINUM CLADDING AB 48" ALUMINUM BAND AS ASPHALT SHINGLES F FLASHING

- V ROOF VENT (MAXIMUM)
 P PARGING
 PC PARGING

- PC MARGING
 PCH10 PRECAST HEADER 10"
 PCH8 PRECAST HEADER 8"
 PCS PRECAST SILL
 PCB PRECAST BAND
 VS VINYL SHAKES
 VEC SIDING (VERTICAL CORNER)

2012 O.B.C. DRAWINGS

REV-1 NEW STANDARD DRWG MODIFICATION 13/11/2017 MAD NO DESCRIPTION

RAWING:

ELEVATION A - FRONT


SCALE: 3/16" = 1'-0"

1035 - THE MORROW

2020 FOOTPRINT

A1a

xx/xx/xxxx

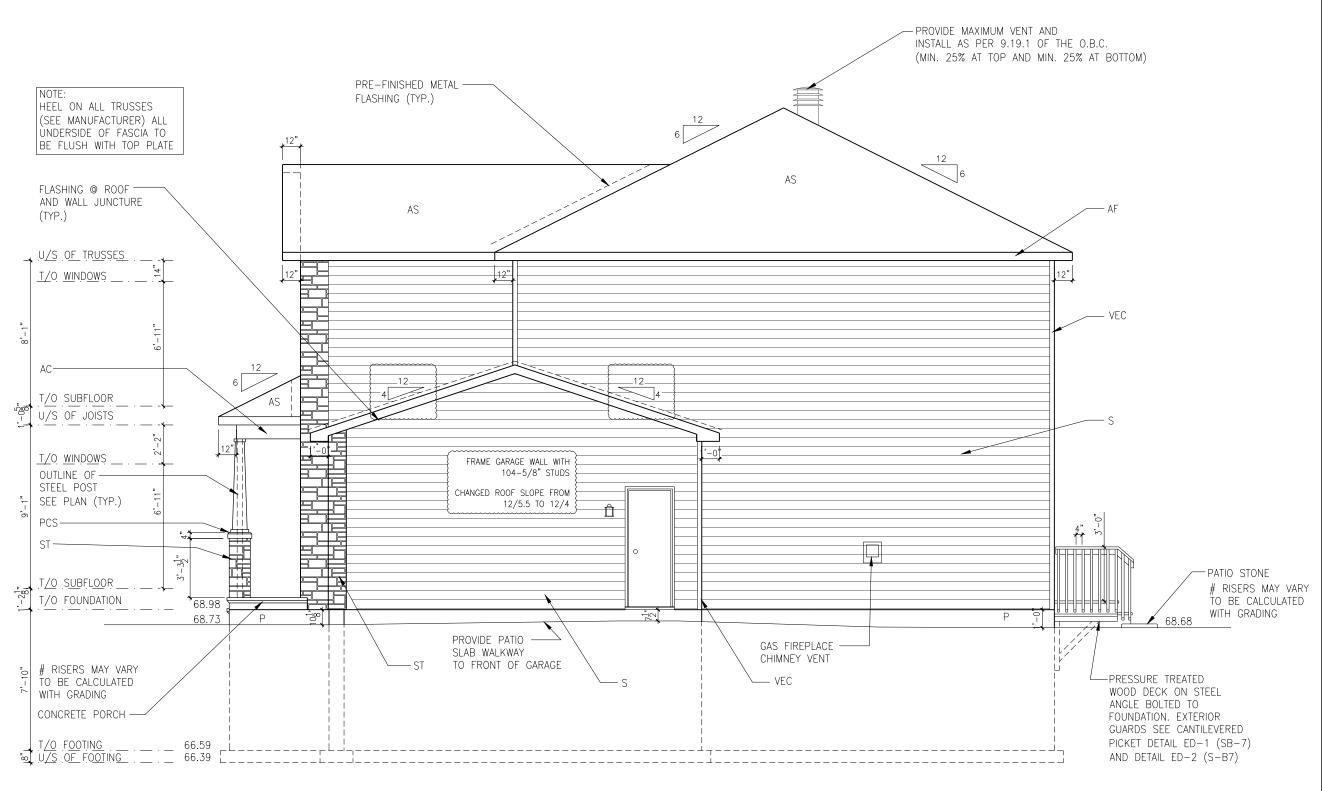

LOT: 4 - PST PH. 5 DATE: 10/29/2020



I, MARC-ANDRE DECOEUR, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BCIN #44555
- TARION REGISTRATION NUMBER #611
- ** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM *

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS LTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING OCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

- B BRICK (MAIN)
- B1 BRICK SOLDIER COURSE (ACCENT)
 B2 BRICK SOLDIER COURSE (ACCENT)
- + 20mm PROUD B3 BRICK SLEEPER COURSE

- -20 BRICK 20mm RECESSED
 S SIDING (HORIZONTAL)
 ST STONE VENEER
 T TRIM 200mm COVE SIDING
 AF ALUMINUM FASCIA
 AC ALUMINUM CLADDING
 AB 48" ALUMINUM BAND
 AS ASPHALT SHINGLES
 F FLASHING

- V ROOF VENT (MAXIMUM)
 P PARGING
 PC PARGING
- PCH 0 PRECAST HEADER 10"
 PCH8 PRECAST HEADER 8"
 PCS PRECAST SILL
 PCB PRECAST BAND
 VS VINYL SHAKES
 VEC SIDING (VERTICAL CORNER)

2012 O.B.C. DRAWINGS

REV-1 NEW STANDARD DRWG MODIFICATION 13/11/2017 MAD NO DESCRIPTION

RAWING:


ELEVATION A - RIGHT

xx/xx/xxxx

A2a

SCALE: 3/16" = 1'-0"

1035 - THE MORROW 2020 FOOTPRINT

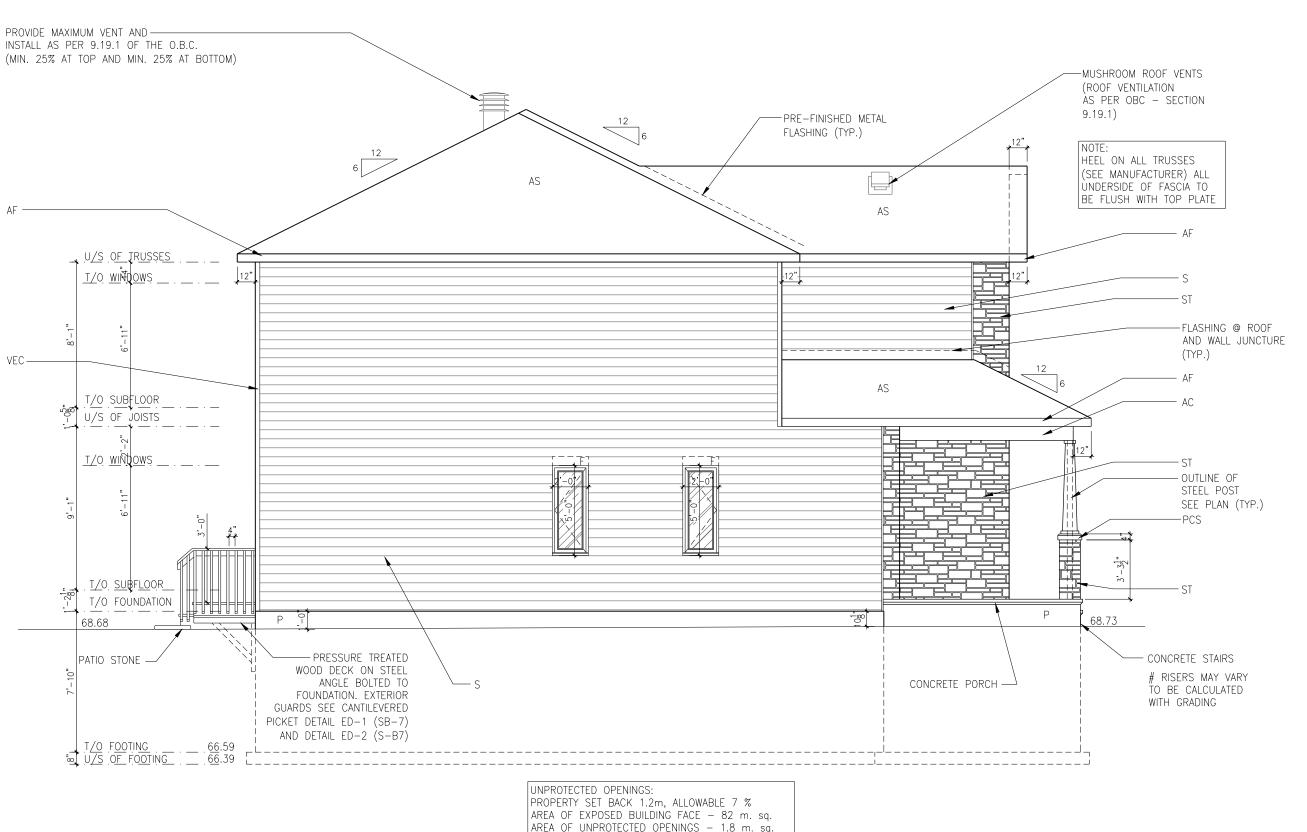

PERCENTAGE OF UNPROTECTED OPENINGS - 2.2 %

LOT: 4 - PST PH. 5 DATE: 10/29/2020



I, MARC-ANDRE DECOEUR, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BCIN #44555 TARION REGISTRATION NUMBER #611
- ** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM *

HIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

- B BRICK (MAIN)
- B1 BRICK SOLDIER COURSE (ACCENT)
 B2 BRICK SOLDIER COURSE (ACCENT)
- + 20mm PROUD B3 BRICK SLEEPER COURSE

- BRICK SLEEPER COURSE
 STACK BOND (ACCENT)
 BRICK SULL (ACCENT)
 BRICK CORBELLING
 BRICK CORBELLING
 BRICK CONINING 20mm PROUD
 BRICK 20mm PROUD
 BRICK 20mm RECESSED
 SUNING (ADRIZONTAL)
- BRICK ZUMM RECESSED
 SIDING (HORIZONTAL)
 STONE VENEER
 TRIM 200mm COVE SIDING
 ALUMINUM FASCIA
 ALUMINUM CLADDING
 48" ALUMINUM BAND
 ASPHALT SHINGLES
 FLASHING

- V ROOF VENT (MAXIMUM)
 P PARGING
 PC PARGING
- PC MARGING
 PCH10 PRECAST HEADER 10"
 PCH8 PRECAST HEADER 8"
 PCS PRECAST SILL
 PCB PRECAST BAND
 VS VINYL SHAKES
 VEC SIDING (VERTICAL CORNER)

2012 O.B.C. DRAWINGS

REV-1 NEW STANDARD DRWG MODIFICATION 13/11/2017 MAD NO DESCRIPTION

RAWING:


ELEVATION A - LEFT

SCALE: 3/16" = 1'-0" xx/xx/xxxx

1035 - THE MORROW 2020 FOOTPRINT

(STANDARD DRAWINGS)

A3a

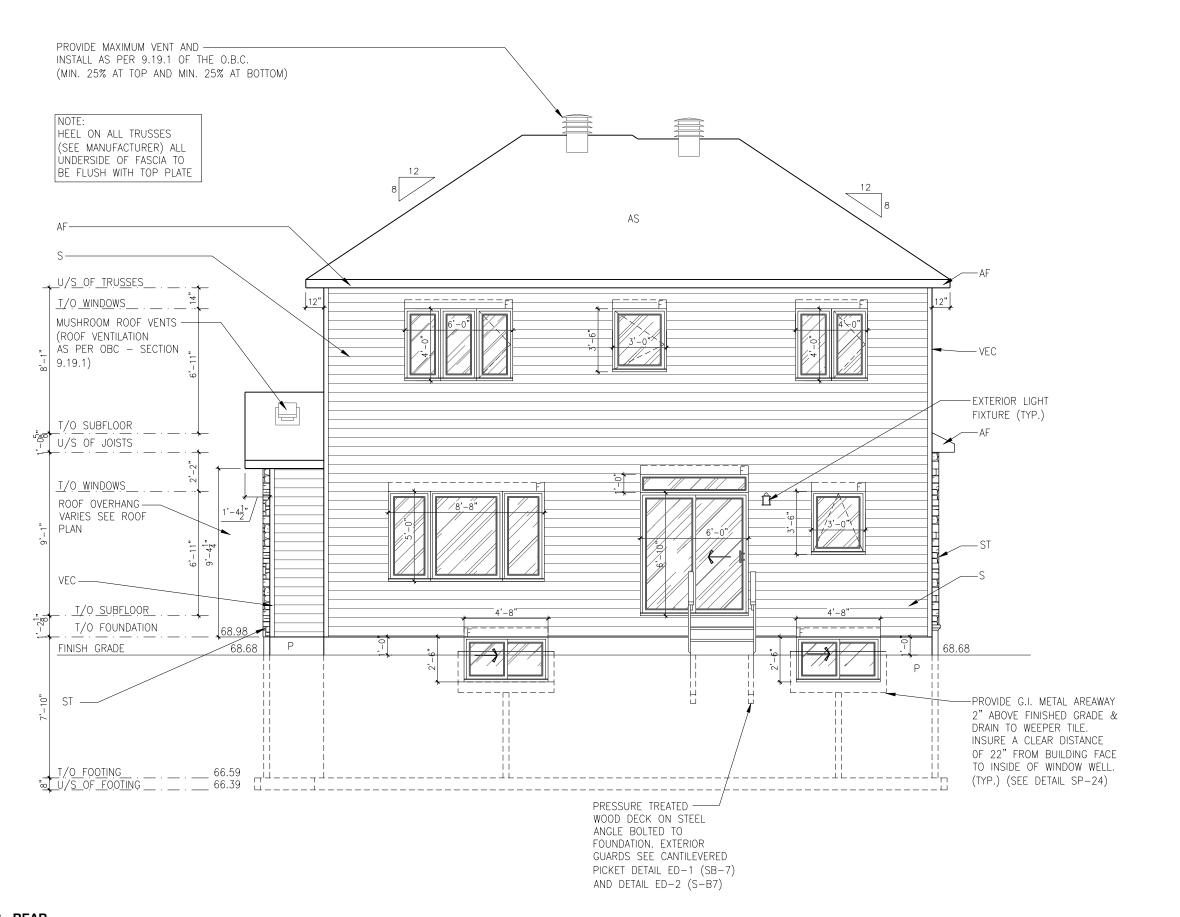

LOT: 4 - PST PH. 5 DATE: 10/29/2020



I, MARC-ANDRE DECOEUR, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BCIN #44555 TARION REGISTRATION NUMBER #611
- ** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM *

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

- B BRICK (MAIN)
- B1 BRICK SOLDIER COURSE (ACCENT)
 B2 BRICK SOLDIER COURSE (ACCENT)
 + 20mm PROUD
 B3 BRICK SLEEPER COURSE

- -20 BRICK 20mm RECESSED S SIDING (HORIZONTAL) ST STONE VENEER T TRIM 200mm COVE SIDING AF ALUMINUM FASCIA AC ALUMINUM CLADDING AB 48* ALUMINUM BAND AS ASPHALT SHINGLES F FLASHING
- V ROOF VENT (MAXIMUM)
 P PARGING
 PC PARGING
- PC MARGING
 PCH10 PRECAST HEADER 10"
 PCH8 PRECAST HEADER 8"
 PCS PRECAST SILL
 PCB PRECAST BAND
 VS VINYL SHAKES
 VEC SIDING (VERTICAL CORNER)

2012 O.B.C. DRAWINGS


REV-1	NEW STANDARD DRWG MODIFICATION	13/11/2017	MA
NO	DESCRIPTION	DATE	RY

ELEVATION A-B-C - REAR SCALE: 3/16" = 1'-0"

1035 - THE MORROW 2020 FOOTPRINT

A4a

xx/xx/xxxx

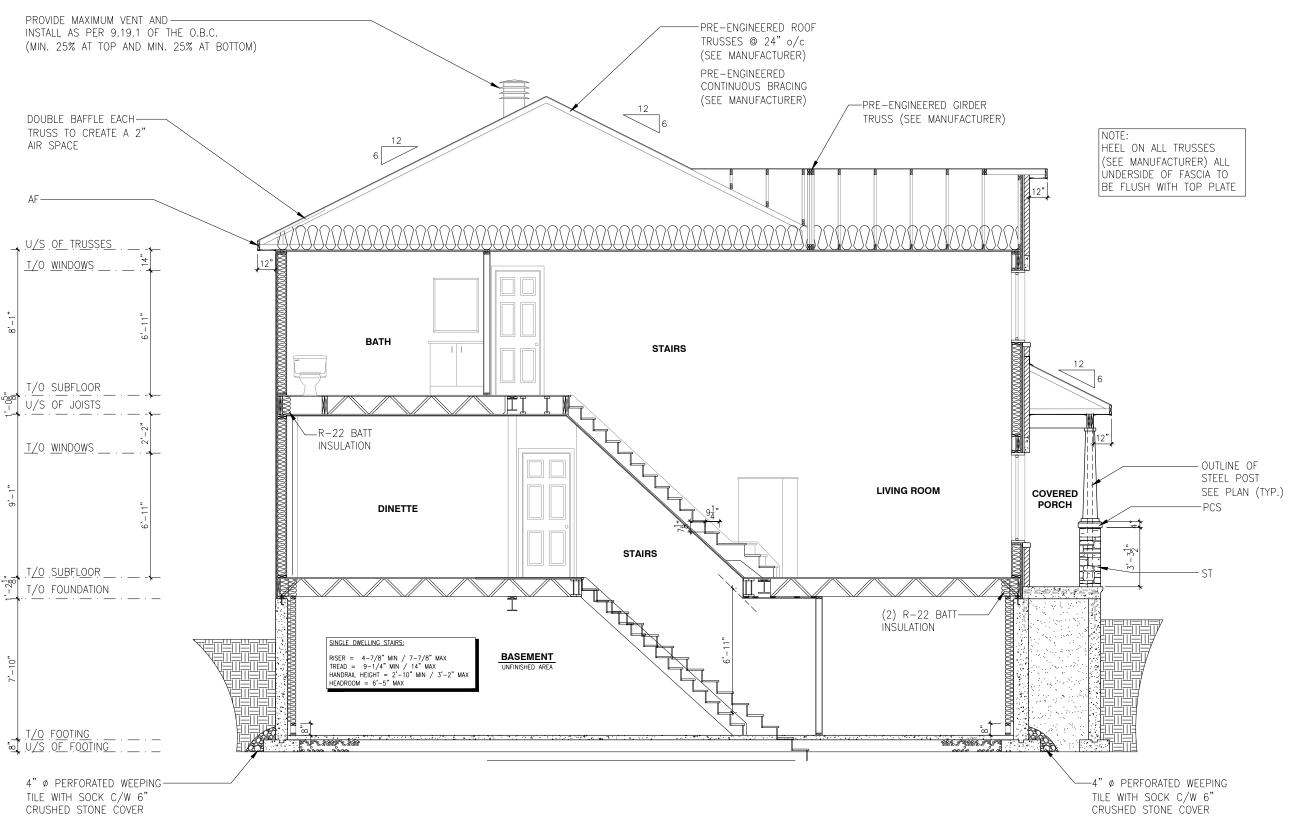

LOT: 4 - PST PH. 5 10/29/2020

I, MARC-ANDRE DECOEUR, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

PERSONAL BCIN #44555 TARION REGISTRATION NUMBER #611

** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM *

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS LTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING OCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

B - BRICK (MAIN)

B1 - BRICK SOLDIER COURSE (ACCENT)
B2 - BRICK SOLDIER COURSE (ACCENT)

+ 20mm PROUD B3 - BRICK SLEEPER COURSE

-20 - BRICK 20mm RECESSED S - SIDING (HORIZONTAL) ST - STONE VENEER T - TRIM 200mm COVE SIDING AF - ALUMINUM FASCIA AC - ALUMINUM CLADDING AB - 48" ALUMINUM BAND AS - ASPHALT SHINGLES F - FLASHING

V - ROOF VENT (MAXIMUM)
P - PARGING
PC - PARGING

PCH 0 - PRECAST HEADER 10"
PCH8 - PRECAST HEADER 8"
PCS - PRECAST SILL
PCB - PRECAST BAND
VS - VINYL SHAKES
VEC - SIDING (VERTICAL CORNER)

2012 O.B.C. DRAWINGS

REV-1 NEW STANDARD DRWG MODIFICATION 13/11/2017 MAD

IO DESCRIPTION

(STANDARD DRAWINGS)

BUILDING SECTION ELEVATION A

SCALE: 3/16" = 1'-0"

1035 - THE MORROW 2020 FOOTPRINT

A5a

xx/xx/xxxx

		FOOTING SC	HEDULE		
	ALLOWABLE SOIL BEARING CAPACITY / BEARING RESISTANCE AT SLS FOR «SITE CLASS:D»				
WALL FOOTINGS	100KPa	85KPa	75KPa	60KPa	40KPa
WF1	30"x8" DP. 2—15M(B) LONG.	36"x8" DP. 15M(B)x32"Lg ◎ 20" o/c 3−15M(B) LONG.	40"x8" DP. 15M(B)x36"Lg	48"x8" DP. 15M(B)x42"Lg @ 16" o/c 3−15M(B) LONG.	N/A
WF2	28"x8" DP. 2-15M(B) LONG.	34"x8" DP. 2-15M(B) LONG.	38"x8" DP. 15M(B)x34"Lg	46"x8" DP. 15M(B)x42"Lg @ 16" o/c 3-15M(B) LONG.	N/A
WF3	26"x8" DP. 2-15M(B) LONG.	30"x8" DP. 2-15M(B) LONG.	34"x8" DP. 2-15M(B) LONG.	42"x8" DP. 15M(B)x38"Lg @ 20" o/c 3−15M(B) LONG.	N/A
WF4	24"x8" DP. 2-15M(B) LONG.	28"x8" DP. 2-15M(B) LONG.	32"x8" DP. 2-15M(B) LONG.	38"x8" DP. 15M(B)x34"Lg @ 20" o/c 3−15M(B) LONG.	N/A
WF5	24"x8" DP. 2-15M(B) LONG.	24"x8" DP. 2-15M(B) LONG.	26"x8" DP. 2-15M(B) LONG.	34"x8" DP. 2-15M(B) LONG.	N/A
WF6	24"x8" DP. 2-15M(B) LONG.	24"x8" DP. 2-15M(B) LONG.	24"x8" DP. 2-15M(B) LONG.	30"x8" DP. 2-15M(B) LONG.	52"x10" with 5−15M bars longitudinal bars are transverse 15M bars @ 16"o.c.
WF7	20"x8" DP. 2-15M(B) LONG.	20"x8" DP. 2-15M(B) LONG.	20"x8" DP. 2-15M(B) LONG.	24"x8" DP. 2-15M(B) LONG.	36"x10" with 3−15M bars longitudinal bars are transverse 15M bars @ 16"o.c.
		PAD FOOTING SCHEDULE			
	ALLOWABLE SOIL BEA	ARING CAPACITY / BEARING RESISTANCE AT SLS FO	R «SITE CLASS:D»		
WALL FOOTINGS	100KPa	85KPa	75KPa	60KPa	40KPa
F1	40"x40"x10" DP.3-15M (B)x34" LG.EW.	44"x44"x10" DP. 3-15M (B)x38" LG.EW	48"x48"x10" DP. 4-15M (B)x42" LG.EW	52"x52"x10" DP. 4-15M (B)x46" LG.EW	64"x64"x12" WITH 5-15M BARS IN BOTH DIRECTION
F2	24"x24"x10" DP.	24"x24"x10" DP.	24"x24"x10" DP.	28"x28"x12" DP.	34"x34"x12" WITH 3-15M BARS IN BOTH DIRECTION

FOOTING TABLE

SCALE: 3/16" = 1'-0"

LOT: 4 - PST PH 5 DATE: 10/29/2020



I, MARC-ANDRE DECOEUR, ARCHITECTURAL MANAGER FOR VALEGRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BCIN #44555
- TARION REGISTRATION NUMBER #611
- ** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM **

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANCES
DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW
ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS
ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING
DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

NOTES:	
STEEL	LINTE

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10 S6 = L 200x100x12
- S7 = L 150x100x10 (8" BEARING)

LINTEL TABLE:

- * IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

POST TABLE:

- PIOS INSELE:

 P1 = 3" ADJUSTABLE STEEL COLUMN
 P10 = HEAWY DUTY, TYPE 2, ADJUSTABLE RED JACK
 POST BY USP
 P2 = 2-2x4 OR 2-2x6
 P3 = 3-2x4 OR 3-2x6
 P4 = 4-2x4 OR 4-2x6
 P5 = 5-2x4 OR 5-2x6
 P5 = 5-2x4 OR 5-2x6
 P13 = HSS 88.9x8.89.x3.18 + 100x200x12 T&B PL. (*)
 P14 = HSS 88.9x8.89.x3.18 + 100x200x12 T&B PL. (*)
 P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (*)
 P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (*)
 P17 = HSS 73 O.D.x4.8 + 100x180x12 BOTTOM PL.
 + 130x160x10 TOP PL. (*)
 (*) = 2-12e ANCH. (WHERE ANCH. PL. NOT USED)
- POST ARE ALL JACK c/w STUD
 (EX. P2 = 1 JACK + 1 STUD)
 IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"



- SMOKE ALARMS AS PER SECTION 9.10.19. OF THE
 ONTARIO BUILDING CODE:

 SHALL HAVE A VISUAL SIGNALING DEVICE;

 ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;

 ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

 ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND

 CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.



= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

2012 O.B.C. DRAWINGS


REV-1	NEW STANDARD DRWG MODIFICATION	13/11/2017	MAD
NO.	DESCRIPTION	DATE	BY

FOOTING TABLE

SCALE: 3/16" = 1'-0" xx/xx/xxxx

1035 - THE MORROW 2020 FOOTPRINT

A6

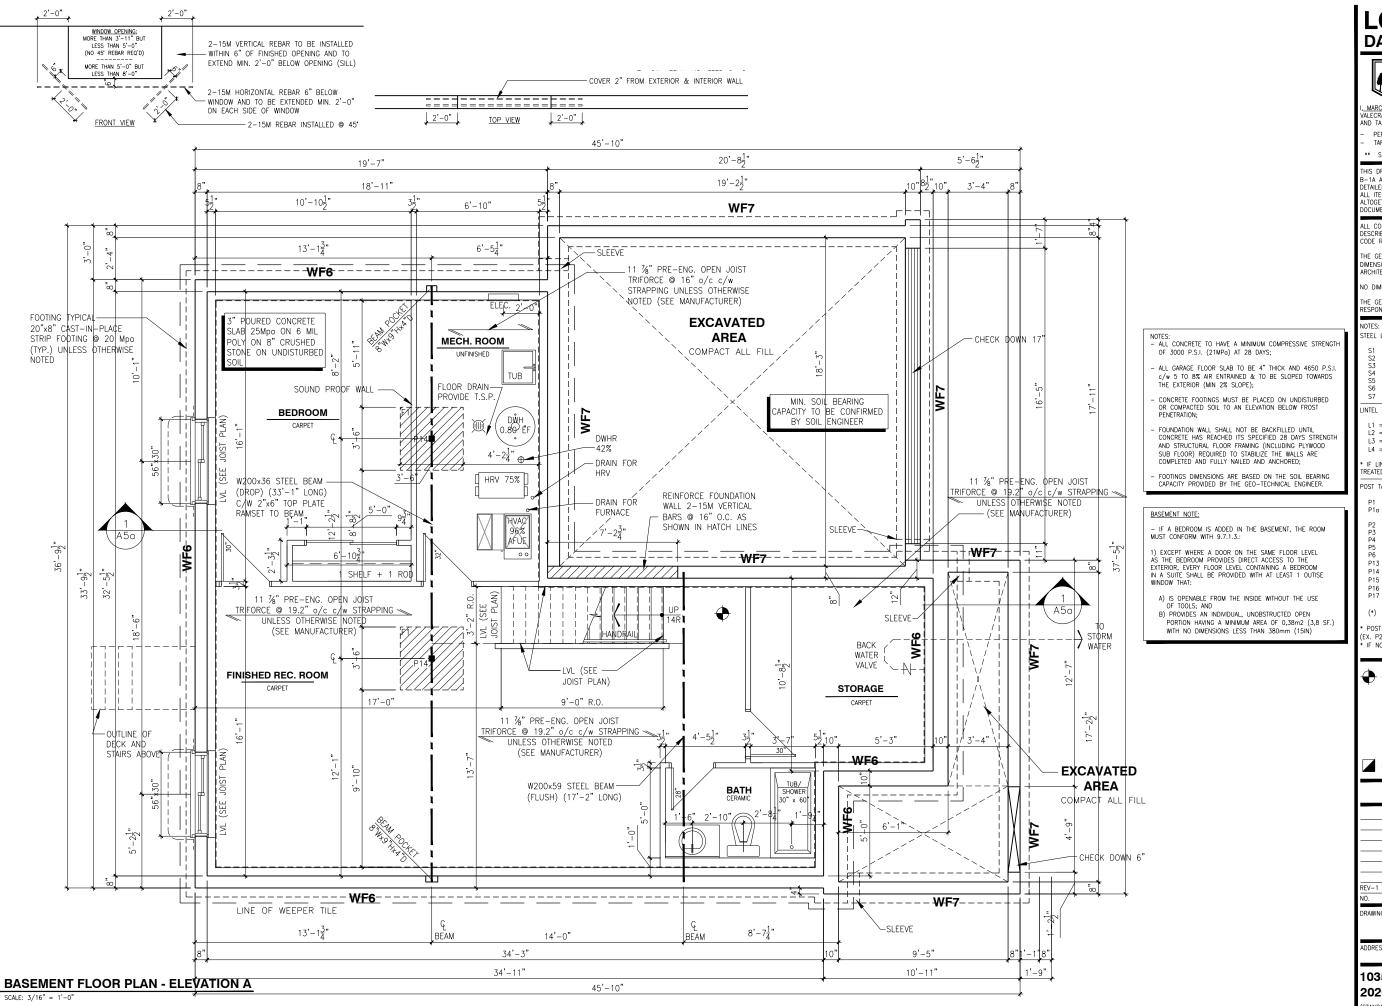

L**OT**: 4-PST PH 5 DATE: 10/29/2020



I, MARC-ANDRE DECOEUR, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BOIN #44555
- TARION REGISTRATION NUMBER #611
- ** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM *

HIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW LITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS. TOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

STEEL LINTEL:

- L 90x90x6 L 90x90x8 L 100x90x8
- = L 125x90x8 = L 125x90x10
- L 200x100x12
- S7 = L 150x100x10 (8" BEARING)

- L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES
- $L3 = 2-1.75 \times 9.5$ LVL (1.8E) + P3 ON BOTH SIDES
- L4 = 3-1.75x9.5 LVL (1.8E) + P3 ON BOTH SIDES
- * IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

POST TABLE:

P1 = 3* ADJUSTABLE STEEL COLUMN
P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-2x4 OR 2-2x6
P3 = 3-2x4 OR 3-2x6

P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (*)

P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (*)

P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (*) P17 = HSS 73 0.0.x4.8 + 100x180x12 BOTTOM PL.

(*) = 2-12ø ANCH, (WHERE ANCH, PL, NOT USED)

POST ARE ALL JACK c/w STUD (EX. P2 = 1 JACK + 1 STUD)

* IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

= SMOKE ALARMS AS PER SECTION 9.10.19. OF THE
ONTARIO BUILDING CODE:
- SHALL HAVE A VISUAL SIGNALING DEVICE;
- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;
- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

- ARE REQUIRED ON EACH SIGNEY, INCLUDING BASEMENT,
- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN
ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING
POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION,
FOLLOWED BY, 4 MINUTES OF ALARM; AND
- CARBON MONOXIDE ALARM ARE ALSO REQUIRED
ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

2012 O.B.C. DRAWINGS

REV-1 NEW STANDARD DRWG MODIFICATION 13/11/2017 MAD IO DESCRIPTION

BASEMENT FLOOR PLAN ELEVATION A


SCALE: 3/16" = 1'-0"

1035 - THE MORROW

2020 FOOTPRINT

A6a

XX/XX/XXXX

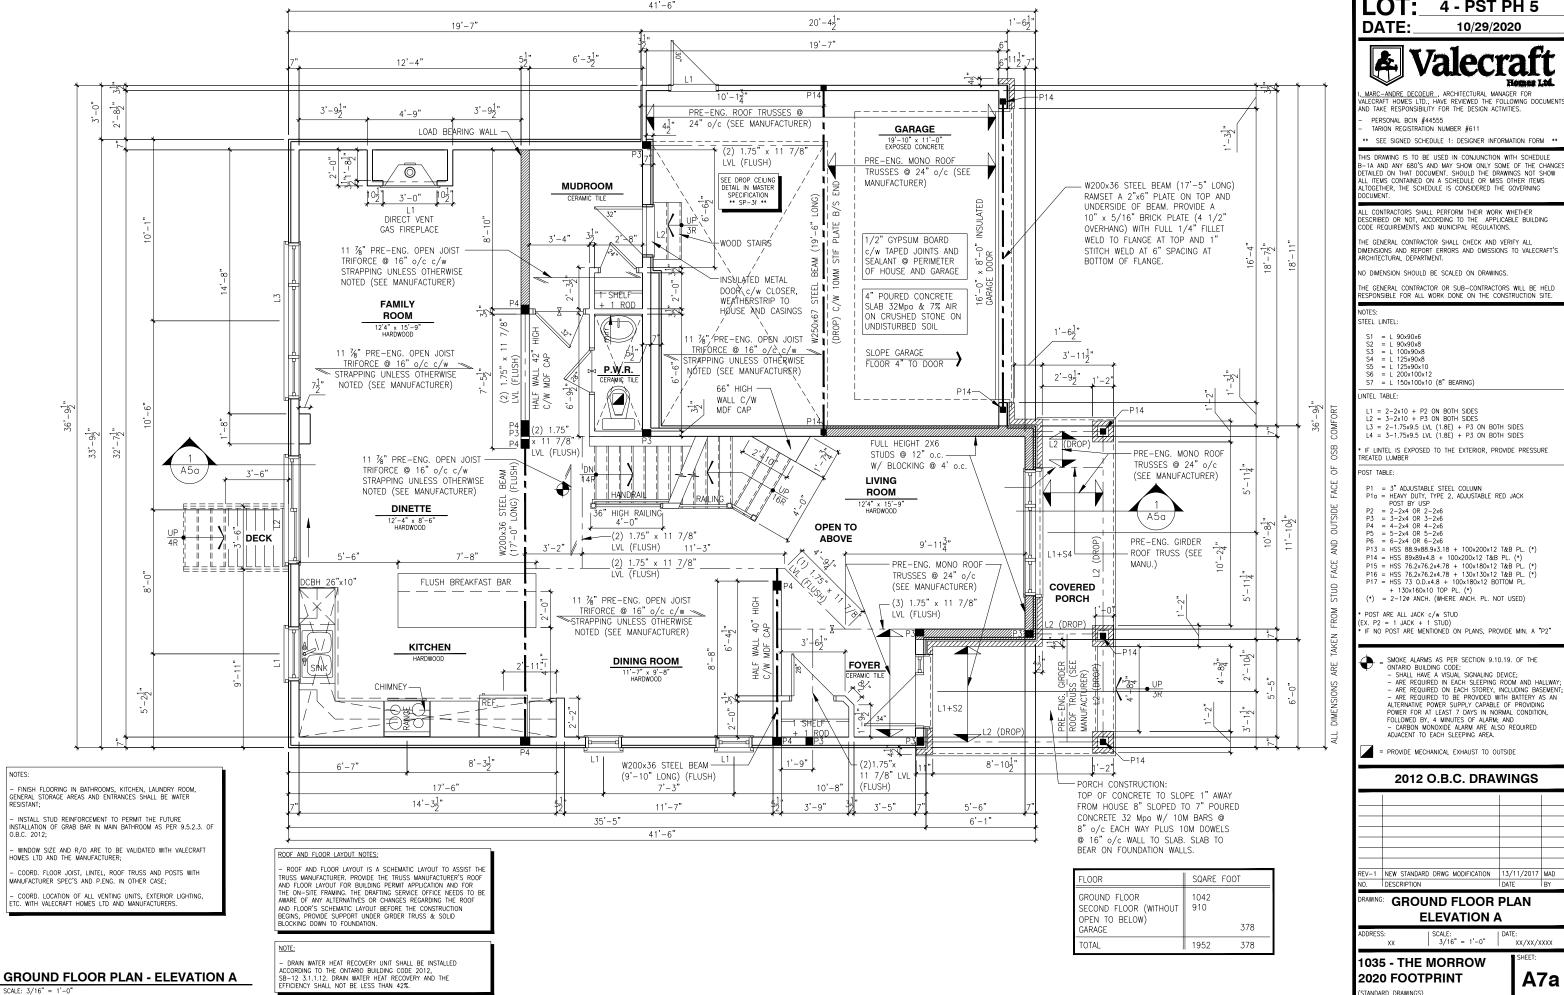


L**OT**: 4-PST PH 5 10/29/2020



MARC-ANDRE DECOEUR, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

IIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE I-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE ETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW LITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS.

DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S




IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE

P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (*)

P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL

ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN

2012 O.B.C. DRAWINGS



RAWING: GROUND FLOOR PLAN

XX/XX/XXXX

A7a



FINISH FLOORING IN BATHROOMS KITCHEN LALINDRY ROOM - FINISH FLUUKING IN MATHROOMS, KITCHEN, LAUNDRY ROO GENERAL STORAGE AREAS AND ENTRANCES SHALL BE WATER RESISTANT;

- INSTALLATION OF GRAB BAR IN MAIN BATHROOM AS PER 9.5.2.3. OF 0.B.C. 2012;
- WINDOW SIZE AND R/O ARE TO BE VALIDATED WITH VALECRAFT HOMES LTD AND THE MANUFACTURER;
- COORD. FLOOR JOIST, LINTEL, ROOF TRUSS AND POSTS WITH MANUFACTURER SPEC'S AND P.ENG. IN OTHER CASE:
- COORD. LOCATION OF ALL VENTING UNITS, EXTERIOR LIGHTING, ETC. WITH VALECRAFT HOMES LTD AND MANUFACTURERS.

ROOF AND FLOOR LAYOUT NOTES:

ROOF AND FLOOR LAYOUT IS A SCHEMATIC LAYOUT TO ASSIST THE TRUSS MANUFACTURER. PROVIDE THE TRUSS MANUFACTURER'S ROOF AND FLOOR LAYOUT FOR BUILDING PERMIT APPLICATION AND FOR THE ON-SITE FRAMING, THE DRAFTING SERVICE OFFICE NEEDS TO BE AWARE OF ANY ALTERNATIVES OR CHANGES REGARDING THE ROOF AND FLOOR'S SCHEMATIC LAYOUT BEFORE THE CONSTRUCTION BEGINS, PROVIDE SUPPORT UNDER GIRDER TRUSS & SOLID BLOCKING DOWN TO FOUNDATION.

NOTE:

DRAIN WATER HEAT RECOVERY UNIT SHALL BE INSTALLED ACCORDING TO THE ONTARIO BUILDING CODE 2012, SB-12 3.1.1.12.
DRAIN WATER HEAT RECOVERY AND THE EFFICIENCY SHALL NOT BE LESS THAN 42%.


STAIRS AND RAILINGS:

RISERS AND TREADS TO BE UNIFORM:

RISE: MIN 125mm (4 7/8") - MAX 200mm (7 7/8") RUN: MIN 210mm (8 1/4") - MAX 355mm (14") TREAD: MIN 235mm (9 1/4") - MAX 355mm (14") WIDTH: MIN 860mm (2'-10") HEIGHT OVER STAIRS: MIN 1950mm (6'-5")

LANDING: MIN 860mm (2'-10") OR WIDTH OF STAIRS

- HANDRAILS: MIN 860mm (34") MAX 900mm (36"):
- GUARDS SHALL BE PROVIDED WHEN THERE IS A DIFFERENCE IN ELEVATION MORE THAN 1'-11 5/8" (600mm) BETWEEN THE WALKING SURFACE AND THE ADJACENT SURFACE:
- EXTERIOR GUARDS (BALCONY/DECK RAILINGS) TO BE 3'-6" (1070mm) IN HEIGHT WHERE DECK HEIGHT IS HIGHER THAN 5'-11"
- EXTERIOR GUARDS (BALCONY/DECK RAILINGS) TO BE 3'-0' (915mm) IN HEIGHT WHERE DECK HEIGHT IS BETWEEN 2'-0" AND 5'-11";
- INTERIOR GUARDS SHALL NOT BE LESS THAN 900mm (2'-11") IN
- MAXIMIM SPACING BETWEEN VERTICAL MEMBERS IS 4" (100mm) MIN. AND TO COMPLY WITH SECTION 9.8 OF THE ONTARIO BUILDING CODE AND SB-7 OF THE ONTARIO BUILDING CODE SUPPLEMENT.

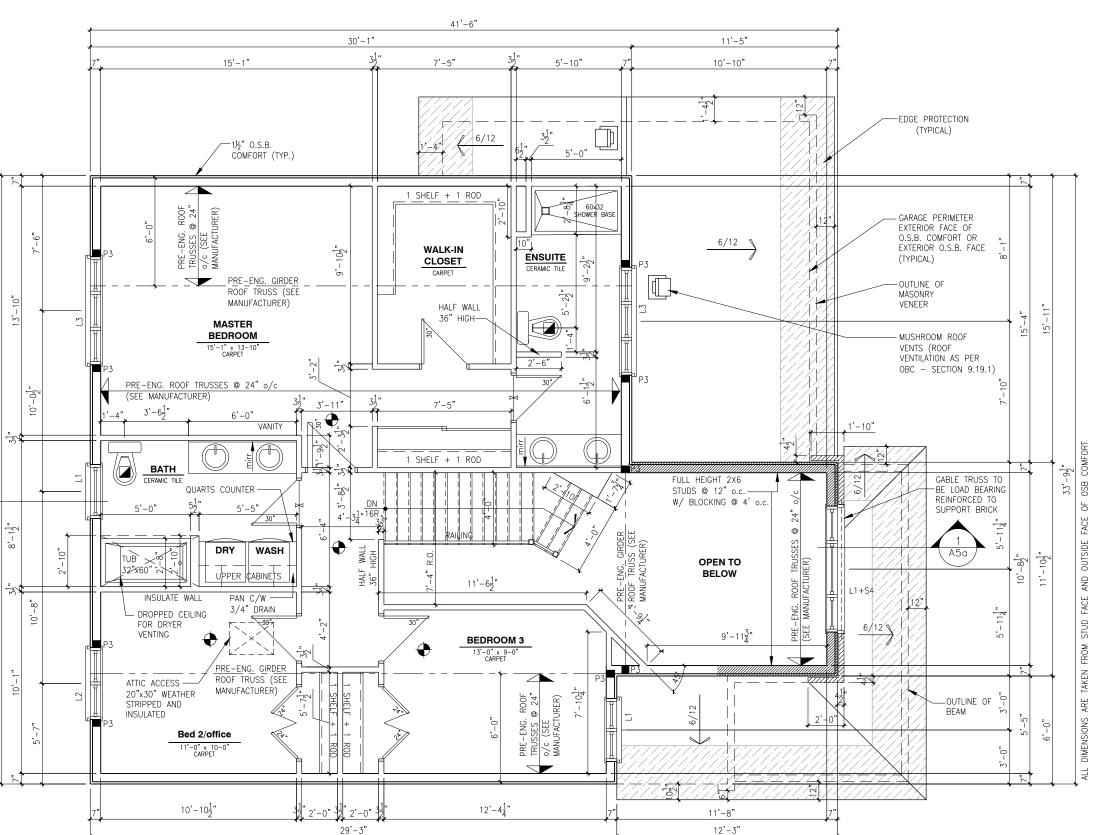

41'-6"

L**OT**: 4-PST PH 5 DATE: 10/29/2020



I, MARC-ANDRE DECOEUR, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BOIN #44555
- TARION REGISTRATION NUMBER #611
- ** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM *


HIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW LITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS. TOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.



 $L3 = 2 - 1.75 \times 9.5$ LVL (1.8E) + P3 ON BOTH SIDES

* IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

POST TARLE:

P1 = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-224 OR 2-2x6
P3 = 3-2x4 OR 3-2x6

P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (*)

P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (*)
P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (*)
P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (*)

P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL

(*) = 2-12ø ANCH, (WHERE ANCH, PL, NOT USED)

POST ARE ALL JACK c/w STUD

(EX. P2 = 1 JACK + 1 STUD)FIF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:

- SHALL HAVE A VISUAL SIGNALING DEVICE;

- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;

- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND

- CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

2012 O.B.C. DRAWINGS

REV-1 NEW STANDARD DRWG MODIFICATION 13/11/2017 MAD IO DESCRIPTION

RAWING: SECOND FLOOR PLAN **ELEVATION A**


SCALE: 3/16" = 1'-0" XX/XX/XXXX

1035 - THE MORROW 2020 FOOTPRINT

(STANDARD DRAWINGS)

A8a

- ROOF AND FLOOR LAYOUT IS A SCHEMATIC LAYOUT TO ASSIST THE - NOUT AND FLOOR LAYOUT IS A SCHEMATIC LAYOUT IN ASSIST INE TRUSS MANUFACTURER'S ROOF AND FLOOR LAYOUT FOR BUILDING PERMIT APPLICATION AND FOR THE ON-SITE FRAMING. THE DRAFTING SERVICE OFFICE NEEDS TO BE AWARE OF ANY ALTERNATIVES OR CHANGES RECARDING THE ROOF AND FLOOR'S SCHEMATIC LAYOUT BEFORE THE CONSTRUCTION BEGINS, PROVIDE SUPPORT UNDER GIRDER TRUSS & SOLID BLOCKING DOWN TO FOUNDATION.

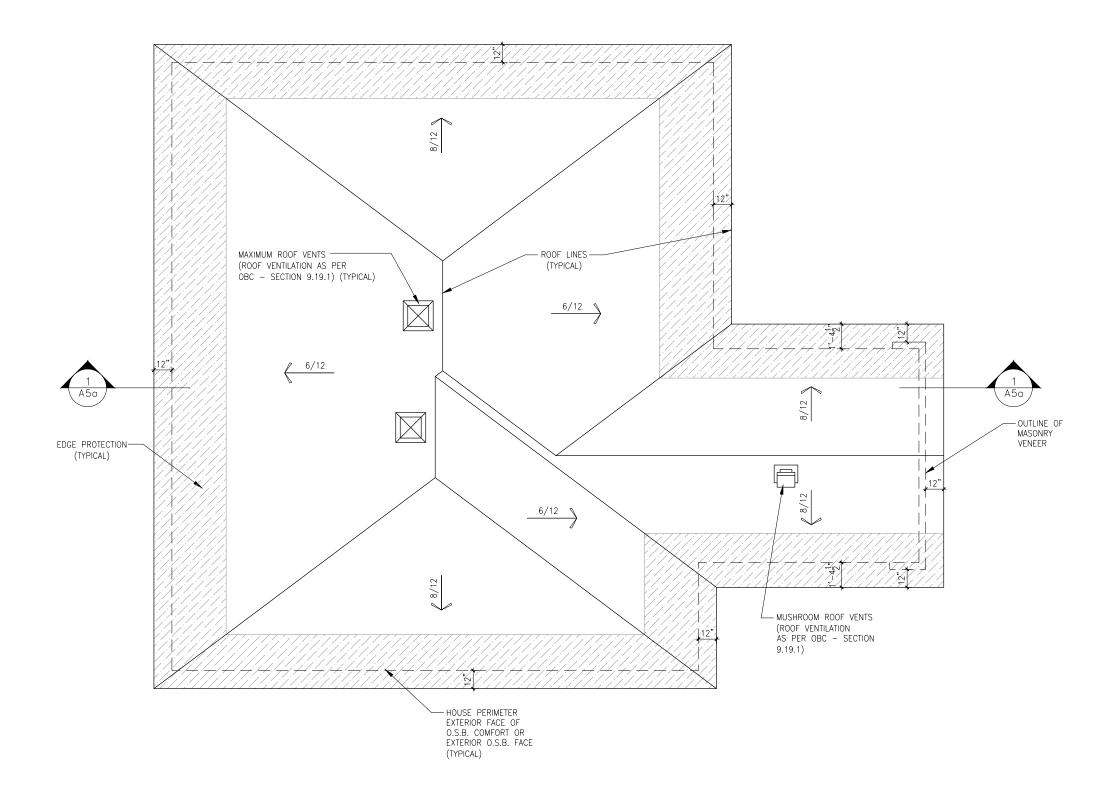

ROOF PLAN - ELEVATION A, C

LOT: 4 - PST PH 5 DATE: 10/29/2020



I, MARC-ANDRE DECOEUR, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BCIN #44555
- TARION REGISTRATION NUMBER #611
- ** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM *

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 580'S AND MAY SHOW ONLY SOME OF THE CHANGES
DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW
ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS
ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING
DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

NOTES:	
STEEL	LINTEL:
S1	= L 90x90x6
S2	= L 90x90x0 = L 90x90x8
S3	= L 100x90x8
S4	= L 125x90x8
\$5	= L 125x90x10
S6	= L 200x100x12
S7	= L 150x100x10 (8" BEARING)

LINTEL TABLE:

 $\mbox{\scriptsize \bullet}$ IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

POST TABLE:

P1 = 3" ADJUSTABLE STEEL COLUMN P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK POST BY USP P2 = 2-2x4 OR 2-2x6 P3 = 3-2x4 OR 3-2x6 P4 = 4-2x4 OR 4-2x6 P5 = 5-2x4 OR 5-2x6 P6 = 6-2x4 OR 6-2x6 P13 = HSS 88,9x88,9x3.18 + 100x200x12 T&B PL (*)

P13 = HSS 88.9884.94.8 + 100x200x12 T&B PL (*)
P14 = HSS 88x984.8 + 100x200x12 T&B PL (*)
P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL (*)
P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL (*)
P17 = HSS 73 0.0.x4.8 + 100x180x12 BOTTOM PL + 130x160x10 TOP PL (*)
(*) = 2-12e ANCH. (WHERE ANCH. PL. NOT USED)

POST ARE ALL JACK c/w STUD
(EX. P2 = 1 JACK + 1 STUD)
IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"



SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:

SHALL HAVE A VISUAL SIGNALING DEVICE;

ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;

ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND

CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

2012 O.B.C. DRAWINGS

REV-1 NEW STANDARD DRWG MODIFICATION 13/11/2017 MAD NO DESCRIPTION

RAWING:


ROOF PLAN ELEVATION A, C

SCALE: 3/16" = 1'-0" DATE: XX/XX/XXXX

1035 - THE MORROW 2020 FOOTPRINT



- ROOF AND FLOOR LAYOUT IS A SCHEMATIC LAYOUT TO ASSIST THE - ROUF AND FLOOR LAYOUT IS A SCHEMARIC LAYOUT IN ASSIST THE TRUSS MANUFACTURER'S ROOF AND FLOOR LAYOUT FOR BUILDING PERMIT APPLICATION AND FOR THE ON-SITE FRAMING. THE DRAFTING SERVICE OFFICE NEEDS TO BE AWARE OF ANY ALTERNATIVES OR CHANGES RECARDING THE ROOF AND FLOOR'S SCHEMATIC LAYOUT BEFORE THE CONSTRUCTION BEGINS, PROVIDE SUPPORT UNDER GIRDER TRUSS & SOLID BLOCKING DOWN TO FOUNDATION.

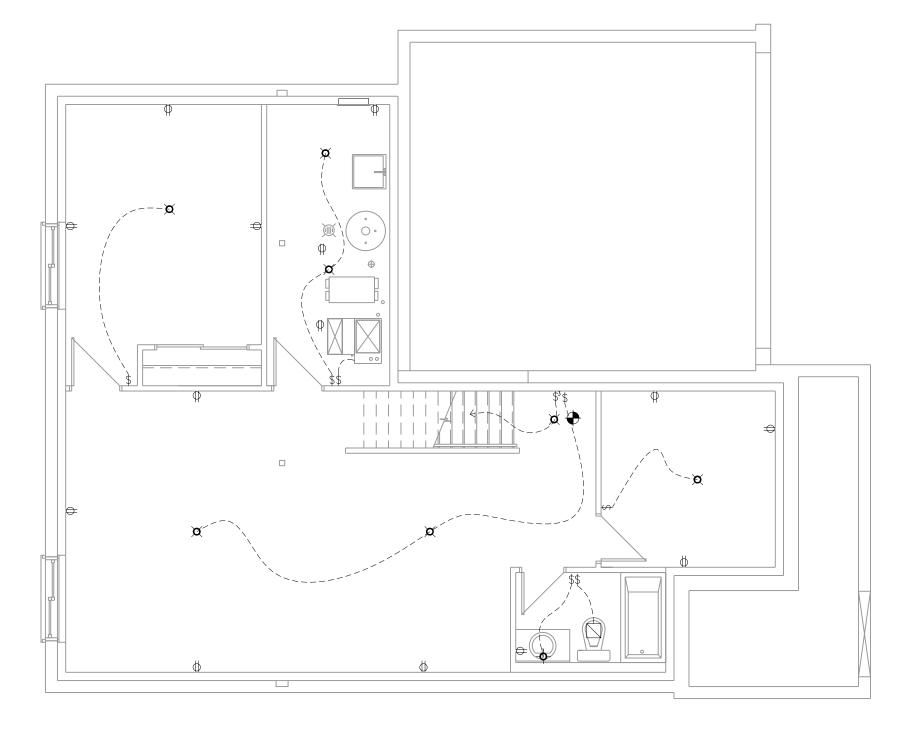

BASEMENT ELECTRICAL

SCALE: 3/16" = 1'-0"

LOT: 4 - PST PH 5 DATE: 10/29/2020



I, MARC-ANDRE DECOEUR, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BCIN #44555
- TARION REGISTRATION NUMBER #611
- ** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM **

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES
DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW
ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS
ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING
DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10 S6 = L 200x100x12
- S7 = L 150x100x10 (8" BEARING)

LINTEL TABLE:

- $\mbox{\scriptsize \bullet}$ IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

POST TABLE:

- P1 = 3" ADJUSTABLE STEEL COLUMN P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK POST BY USP P2 = 2-2x4 OR 2-2x6 P3 = 3-2x4 OR 3-2x6 P4 = 4-2x4 OR 4-2x6 P5 = 5-2x4 OR 5-2x6 P6 = 6-2x4 OR 6-2x6 P13 = HSS 88,9x88,9x3.18 + 100x200x12 T&B PL (*)

- P13 = HSS 88.9884.94.8 + 100x200x12 T&B PL (*)
 P14 = HSS 88x984.8 + 100x200x12 T&B PL (*)
 P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL (*)
 P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL (*)
 P17 = HSS 73 0.0.x4.8 + 100x180x12 BOTTOM PL + 130x160x10 TOP PL (*)
 (*) = 2-12e ANCH. (WHERE ANCH. PL. NOT USED)

POST ARE ALL JACK c/w STUD
(EX. P2 = 1 JACK + 1 STUD)
IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"



- SMOKE ALARMS AS PER SECTION 9.10.19. OF THE
 ONTARIO BUILDING CODE:

 SHALL HAVE A VISUAL SIGNALING DEVICE;

 ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;

 ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

 ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND

 CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.



= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

2012 O.B.C. DRAWINGS

REV-1	NEW STANDARD DRWG MODIFICATION	13/11/2017	MAD
NO.	DESCRIPTION	DATE	BY


BASEMENT ELECTRICAL

SCALE: 3/16" = 1'-0" xx/xx/xxxx 1035 - THE MORROW

2020 FOOTPRINT (STANDARD DRAWINGS)

A9c

ROOF AND FLOOR LAYOUT IS A SCHEMATIC LAYOUT TO ASSIST THE - NOUT AND FLOOR LAYOUT IS A SCHEMATIC LAYOUT IN ASSIST INE TRUSS MANUFACTURER'S ROOF AND FLOOR LAYOUT FOR BUILDING PERMIT APPLICATION AND FOR THE ON-SITE FRAMING. THE DRAFTING SERVICE OFFICE NEEDS TO BE AWARE OF ANY ALTERNATIVES OR CHANGES RECARDING THE ROOF AND FLOOR'S SCHEMATIC LAYOUT BEFORE THE CONSTRUCTION BEGINS, PROVIDE SUPPORT UNDER GIRDER TRUSS & SOLID BLOCKING DOWN TO FOUNDATION.

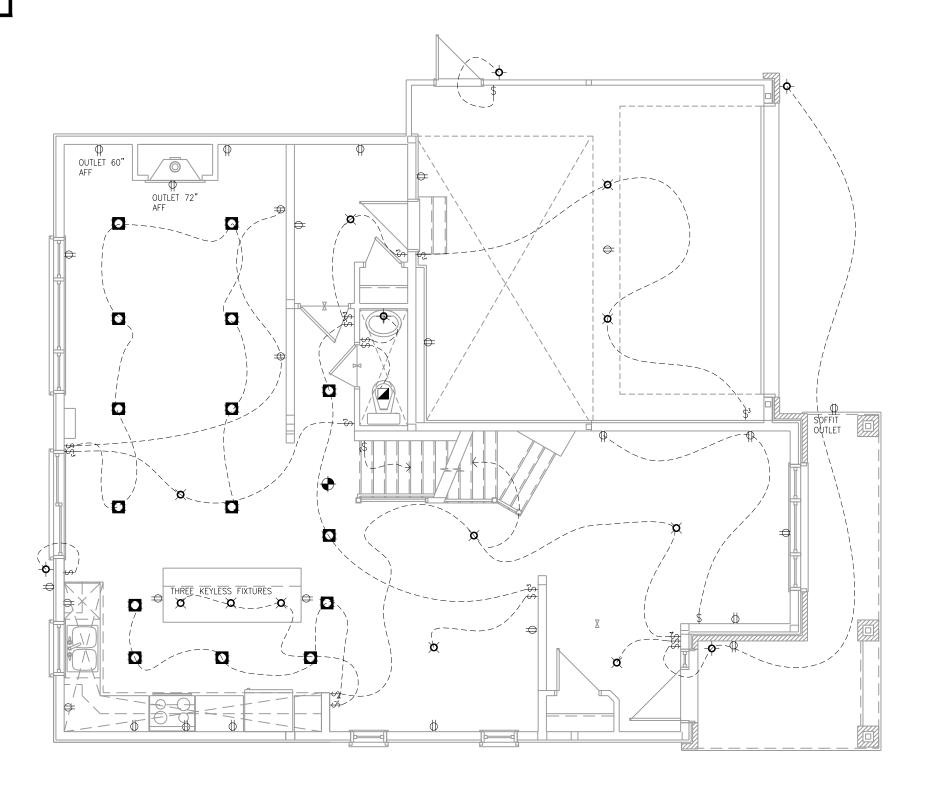

GROUND FLOOR ELECTRICAL

LOT: 4 - PST PH 5 DATE: 10/29/2020



I, MARC-ANDRE DECOEUR, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BCIN #44555
- TARION REGISTRATION NUMBER #611
- ** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM *

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10

- $S6 = 1.200 \times 100 \times 12$
- S7 = L 150x100x10 (8" BEARING)

LINTEL TABLE:

- $\mbox{\scriptsize \bullet}$ IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

POST TABLE:

- P1 = 3" ADJUSTABLE STEEL COLUMN P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK POST BY USP P2 = 2-2x4 OR 2-2x6 P3 = 3-2x4 OR 3-2x6 P4 = 4-2x4 OR 4-2x6 P5 = 5-2x4 OR 5-2x6 P6 = 6-2x4 OR 6-2x6 P13 = HSS 88,9x88,9x318 + 100x200x12 T&B PL (*) P14 = HSS 88,9x88,9x318 + 100x200x12 T&B PL (*)

- P13 = HSS 88.9884.94.8 + 100x200x12 T&B PL (*)
 P14 = HSS 88x984.8 + 100x200x12 T&B PL (*)
 P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL (*)
 P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL (*)
 P17 = HSS 73 0.0.x4.8 + 100x180x12 BOTTOM PL + 130x160x10 TOP PL (*)
 (*) = 2-12e ANCH. (WHERE ANCH. PL. NOT USED)

- POST ARE ALL JACK c/w STUD
 (EX. P2 = 1 JACK + 1 STUD)
 IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"



- SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:

 SHALL HAVE A VISUAL SIGNALING DEVICE;

 ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;

 ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

 ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND

 CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.



= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

2012 O.B.C. DRAWINGS

REV-1	NEW STANDARD DRWG MODIFICATION	13/11/2017	MAD
NO.	DESCRIPTION	DATE	BY

GROUND FLOOR ELECTRICAL


SCALE: 3/16" = 1'-0" XX/XX/XXXX

1035 - THE MORROW 2020 FOOTPRINT

(STANDARD DRAWINGS)

A10b

ROOF AND FLOOR LAYOUT IS A SCHEMATIC LAYOUT TO ASSIST THE - NOUF AND FLOOR LAYOUT IS A SCHEMATIC LAYOUT IN ASSIST INE TRUSS MANUFACTURER, PROVIDE THE TRUSS MANUFACTURER'S ROOF AND FLOOR LAYOUT FOR BUILDING PERMIT APPLICATION AND FOR THE ON-SITE FRAMING. THE DRAFTING SERVICE OFFICE NEEDS TO BE AWARE OF ANY ALTERNATIVES OR CHANGES RECARDING THE ROOF AND FLOOR'S SCHEMATIC LAYOUT BEFORE THE CONSTRUCTION DEFENSE ORDUPE SUIDORST MADER OFFICE THE CONSTRUCTION BEGINS, PROVIDE SUPPORT UNDER GIRDER TRUSS & SOLID BLOCKING DOWN TO FOUNDATION.

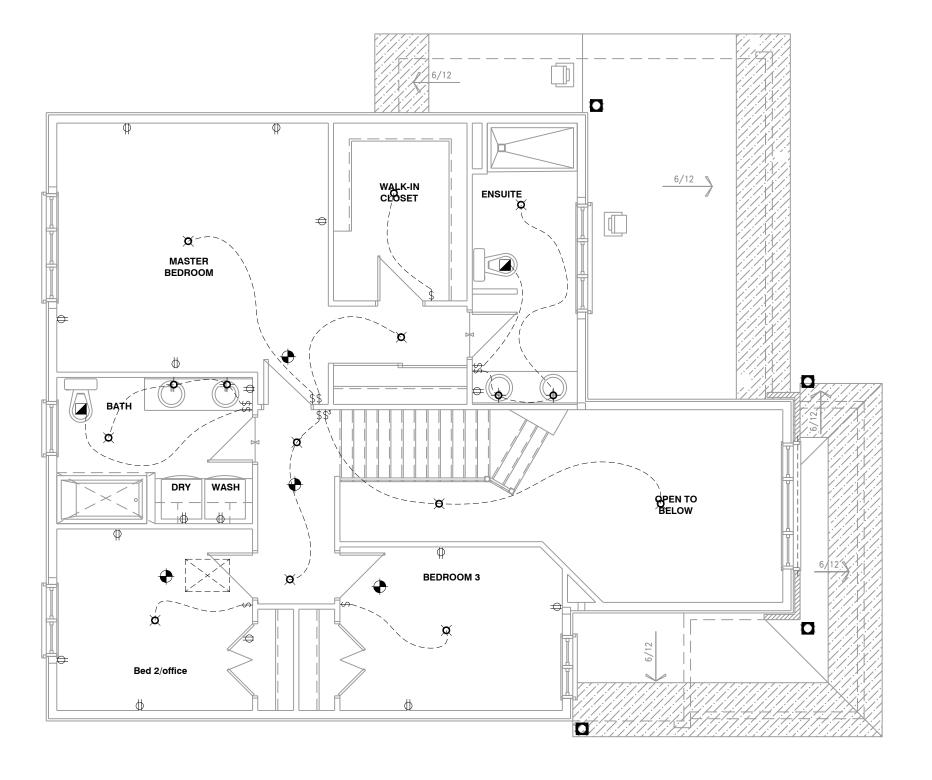

SECOND FLOOR ELECTRICAL

LOT: 4 - PST PH 5 DATE: 10/29/2020



I, MARC-ANDRE DECOEUR, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BCIN #44555
- TARION REGISTRATION NUMBER #611
- ** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM *

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 580'S AND MAY SHOW ONLY SOME OF THE CHANGES
DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW
ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS
ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING
DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10
- $S6 = 1.200 \times 100 \times 12$
- S7 = L 150x100x10 (8" BEARING)

LINTEL TABLE:

- * IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

POST TABLE:

- P1 = 3" ADJUSTABLE STEEL COLUMN P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK POST BY USP P2 = 2-2x4 OR 2-2x6 P3 = 3-2x4 OR 3-2x6 P4 = 4-2x4 OR 4-2x6 P5 = 5-2x4 OR 5-2x6 P6 = 6-2x4 OR 6-2x6 P13 = HSS 88,9x88,9x318 + 100x200x12 T&B PL (*) P14 = HSS 88,9x88,9x318 + 100x200x12 T&B PL (*)

- P13 = HSS 88.9884.94.8 + 100x200x12 T&B PL (*)
 P14 = HSS 88x984.8 + 100x200x12 T&B PL (*)
 P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL (*)
 P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL (*)
 P17 = HSS 73 0.0.x4.8 + 100x180x12 BOTTOM PL + 130x160x10 TOP PL (*)
 (*) = 2-12e ANCH. (WHERE ANCH. PL. NOT USED)

- POST ARE ALL JACK c/w STUD
 (EX. P2 = 1 JACK + 1 STUD)
 IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

- SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:

 SHALL HAVE A VISUAL SIGNALING DEVICE;

 ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;

 ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

 ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND

 CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

2012 O.B.C. DRAWINGS

REV-1	NEW STANDARD DRWG MODIFICATION	13/11/2017	MAC
NO.	DESCRIPTION	DATE	BY

RAWING:

SECOND FLOOR ELECTRICAL

SCALE: 3/16" = 1'-0" XX/XX/XXXX

1035 - THE MORROW 2020 FOOTPRINT

(STANDARD DRAWINGS)

A10c

NOTES:

FINISH FLOORING IN BATHROOMS KITCHEN LALINDRY ROOM GENERAL STORAGE AREAS AND ENTRANCES SHALL BE WATER RESISTANT;

- INSTALLATION OF GRAB BAR IN MAIN BATHROOM AS PER 9.5.2.3. OF O.B.C. 2012;
- WINDOW SIZE AND R/O ARE TO BE VALIDATED WITH VALECRAFT HOMES LTD AND THE MANUFACTURER;
- COORD. FLOOR JOIST, LINTEL, ROOF TRUSS AND POSTS WITH MANUFACTURER SPEC'S AND P.ENG. IN OTHER CASE:
- COORD. LOCATION OF ALL VENTING UNITS, EXTERIOR LIGHTING, ETC. WITH VALECRAFT HOMES LTD AND MANUFACTURERS.

ROOF AND FLOOR LAYOUT NOTES:

- ROOF AND FLOOR LAYOUT IS A SCHEMATIC LAYOUT TO ASSIST THE TRUSS MANUFACTURER. PROVIDE THE TRUSS MANUFACTURER'S ROOF AND FLOOR LAYOUT FOR BUILDING PERMIT APPLICATION AND FOR THE ON-SITE FRAMING, THE DRAFTING SERVICE OFFICE NEEDS TO BE AWARE OF ANY ALTERNATIVES OR CHANGES REGARDING THE ROOF AND FLOOR'S SCHEMATIC LAYOUT BEFORE THE CONSTRUCTION BEGINS, PROVIDE SUPPORT UNDER GIRDER TRUSS & SOLID BLOCKING DOWN TO FOUNDATION.

NOTE:


DRAIN WATER HEAT RECOVERY UNIT SHALL BE INSTALLED ACCORDING TO THE ONTARIO BUILDING CODE 2012, SB-12 3.1.1.12.
DRAIN WATER HEAT RECOVERY AND THE EFFICIENCY SHALL NOT BE LESS THAN 42%.

STAIRS AND RAILINGS:

- RISERS AND TREADS TO BE UNIFORM:

RISE: MIN 125mm (4 7/8") – MAX 200mm (7 7/8") RUN: MIN 210mm (8 1/4") – MAX 355mm (14") TREAD: MIN 235mm (9 1/4") – MAX 355mm (14") WIDTH: MIN 860mm (2'-10") HEIGHT OVER STAIRS: MIN 1950mm (6'-5") LANDING: MIN 860mm (2'-10") OR WIDTH OF STAIRS

- HANDRAILS: MIN 860mm (34") MAX 900mm (36"):
- GUARDS SHALL BE PROVIDED WHEN THERE IS A DIFFERENCE IN ELEVATION MORE THAN 1'-11 5/8" (600mm) BETWEEN THE WALKING SURFACE AND THE ADJACENT SURFACE.
- EXTERIOR GUARDS (BALCONY/DECK RAILINGS) TO BE 3'-6'' (1070mm) IN HEIGHT WHERE DECK HEIGHT IS HIGHER THAN 5'-11'';
- EXTERIOR GUARDS (BALCONY/DECK RAILINGS) TO BE 3'-0" (915mm) IN HEIGHT WHERE DECK HEIGHT IS BETWEEN 2'-0" AND 5'-11";
- INTERIOR GUARDS SHALL NOT BE LESS THAN 900mm (2'-11") IN
- MAXIMIM SPACING BETWEEN VERTICAL MEMBERS IS 4" (100mm) MIN. AND TO COMPLY WITH SECTION 9.8 OF THE ONTARIO BUILDING CODE AND SB-7 OF THE ONTARIO BUILDING CODE SUPPLEMENT.

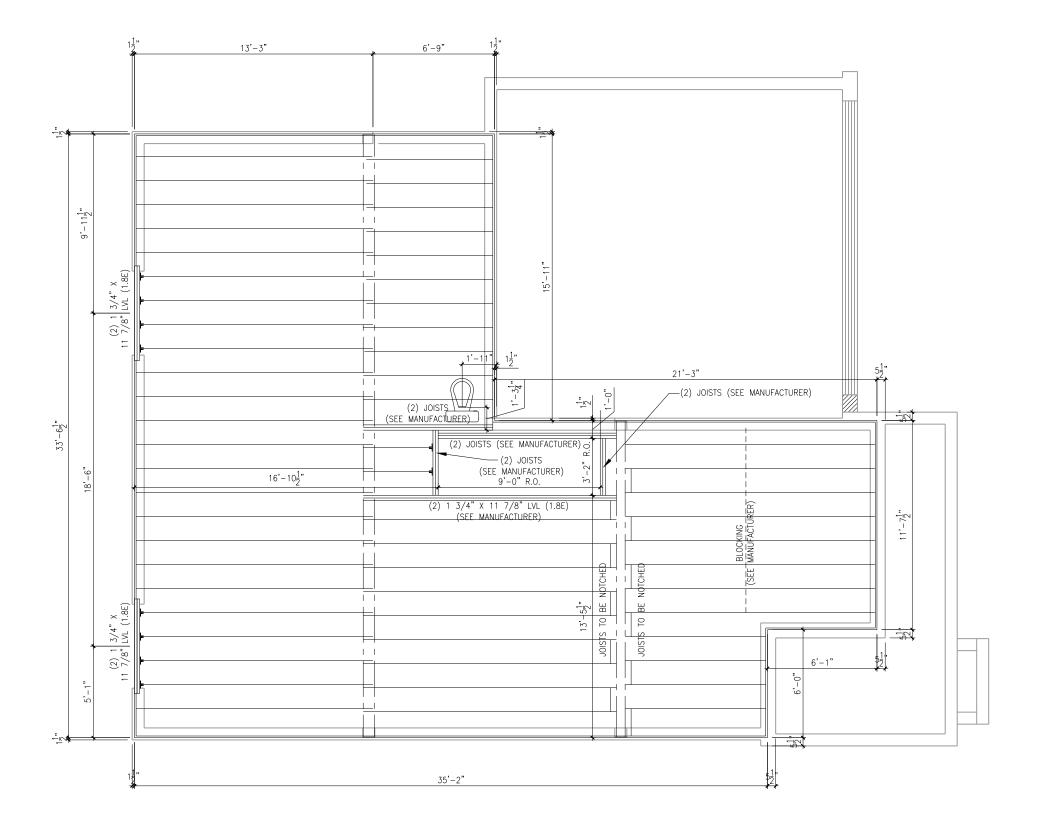

GROUND FLOOR - JOIST PLAN

LOT: 4-PST PH 5 DATE: 10/29/2020



I, MARC-ANDRE DECOEUR, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BOIN #44555
- TARION REGISTRATION NUMBER #611
- ** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM *

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGE DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

NOTES	:		
STEEL	LINTEL:		

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10

- $S6 = 1.200 \times 100 \times 100$ S7 = L 150x100x10 (8" BEARING)


LINTEL TABLE:

- L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES
- $L3 = 2 1.75 \times 9.5$ LVL (1.8E) + P3 ON BOTH SIDES
- * IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

POST TABLE:

- P1 = 3" ADJUSTABLE STEEL COLUMN
 P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
 POST BY USP
 P2 = 2-224 OR 2-2x6
 P3 = 3-2x4 OR 3-2x6

- P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (*)
- 13 133 69.39.48 + 100x200x12 1&B PL. (*) P15 = HSS 89x89x4.8 + 100x200x12 1&B PL. (*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 1&B PL. (*) P16 = HSS 76.2x76.2x4.78 + 130x130x12 1&B PL. (*) P17 = HSS 73 0.0.x4.8 + 100x180x12 BOTTOM PL.
- (*) = 2-12¢ ANCH. (WHERE ANCH. PL. NOT USED)
- * POST ARE ALL JACK c/w STUD (EX. P2 = 1 JACK + 1 STUD)
- * IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"



- SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:

 SHALL HAVE A VISUAL SIGNALING DEVICE;

 ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;

 ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

 ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND

 CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.



= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

2012 O.B.C. DRAWINGS

REV-1	NEW STANDARD DRWG MODIFICATION	13/11/2017	MA(
NO.	DESCRIPTION	DATE	BY

GROUND FLOOR - JOIST PLAN

SCALE: 3/16" = 1'-0" XX/XX/XXXX

1035 - THE MORROW 2020 FOOTPRINT

A11

NOTES:

FINISH FLOORING IN BATHROOMS KITCHEN LALINDRY ROOM GENERAL STORAGE AREAS AND ENTRANCES SHALL BE WATER RESISTANT;

- INSTALLATION OF GRAB BAR IN MAIN BATHROOM AS PER 9.5.2.3. OF O.B.C. 2012;
- WINDOW SIZE AND R/O ARE TO BE VALIDATED WITH VALECRAFT HOMES LTD AND THE MANUFACTURER;
- COORD. FLOOR JOIST, LINTEL, ROOF TRUSS AND POSTS WITH MANUFACTURER SPEC'S AND P.ENG. IN OTHER CASE:
- COORD. LOCATION OF ALL VENTING UNITS, EXTERIOR LIGHTING, ETC. WITH VALECRAFT HOMES LTD AND MANUFACTURERS.

ROOF AND FLOOR LAYOUT NOTES:

ROOF AND FLOOR LAYOUT IS A SCHEMATIC LAYOUT TO ASSIST THE TRUSS MANUFACTURER. PROVIDE THE TRUSS MANUFACTURER'S ROOF AND FLOOR LAYOUT FOR BUILDING PERMIT APPLICATION AND FOR THE ON-SITE FRAMING, THE DRAFTING SERVICE OFFICE NEEDS TO BE AWARE OF ANY ALTERNATIVES OR CHANGES REGARDING THE ROOF AND FLOOR'S SCHEMATIC LAYOUT BEFORE THE CONSTRUCTION BEGINS, PROVIDE SUPPORT UNDER GIRDER TRUSS & SOLID BLOCKING DOWN TO FOUNDATION.

NOTE:


DRAIN WATER HEAT RECOVERY UNIT SHALL BE INSTALLED ACCORDING TO THE ONTARIO BUILDING CODE 2012, SB-12 3.1.1.12. DRAIN WATER HEAT RECOVERY AND THE EFFICIENCY SHALL NOT BE LESS THAN 42%.

STAIRS AND RAILINGS:

- RISERS AND TREADS TO BE UNIFORM:

RISE: MIN 125mm (4 7/8") – MAX 200mm (7 7/8") RUN: MIN 210mm (8 1/4") – MAX 355mm (14") TREAD: MIN 235mm (9 1/4") – MAX 355mm (14") WIDTH: MIN 860mm (2'-10") HEIGHT OVER STAIRS: MIN 1950mm (6'-5") LANDING: MIN 860mm (2'-10") OR WIDTH OF STAIRS

- HANDRAILS: MIN 860mm (34") MAX 900mm (36"):
- GUARDS SHALL BE PROVIDED WHEN THERE IS A DIFFERENCE IN ELEVATION MORE THAN 1'-11 5/8" (600mm) BETWEEN THE WALKING SURFACE AND THE ADJACENT SURFACE.
- EXTERIOR GUARDS (BALCONY/DECK RAILINGS) TO BE 3'-6'' (1070mm) IN HEIGHT WHERE DECK HEIGHT IS HIGHER THAN 5'-11'';
- EXTERIOR GUARDS (BALCONY/DECK RAILINGS) TO BE 3'-0' (915mm) IN HEIGHT WHERE DECK HEIGHT IS BETWEEN 2'-0" AND 5'-11";
- INTERIOR GUARDS SHALL NOT BE LESS THAN 900mm (2'-11") IN
- MAXIMIM SPACING BETWEEN VERTICAL MEMBERS IS 4" (100mm) MIN. AND TO COMPLY WITH SECTION 9.8 OF THE ONTARIO BUILDING CODE AND SB-7 OF THE ONTARIO BUILDING CODE SUPPLEMENT.

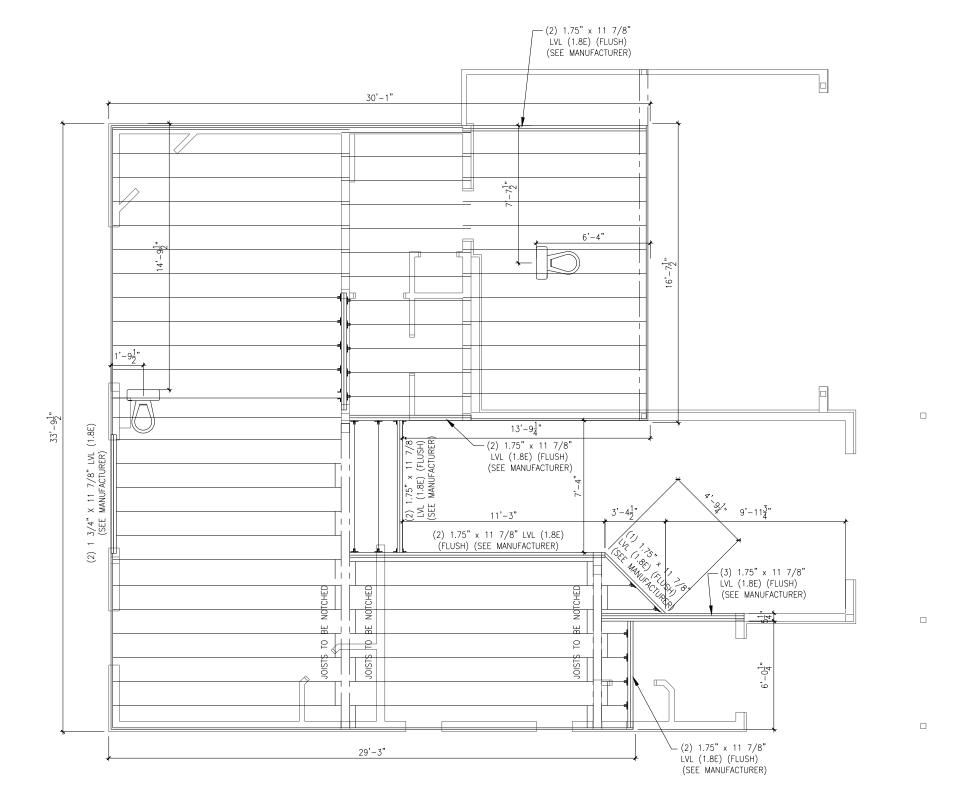

SECOND FLOOR - JOIST PLAN

LOT: 4-PST PH 5 DATE: 10/29/2020



I, MARC-ANDRE DECOEUR, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

- PERSONAL BOIN #44555
- TARION REGISTRATION NUMBER #611
- ** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM *

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

STEEL LINTEL:

- S1 = L 90x90x6 S2 = L 90x90x8 S3 = L 100x90x8 S4 = L 125x90x8 S5 = L 125x90x10
- $S6 = 1.200 \times 100 \times 100$
- S7 = L 150x100x10 (8" BEARING)

LINTEL TABLE:

- L1 = 2-2x10 + P2 ON BOTH SIDES L2 = 3-2x10 + P3 ON BOTH SIDES
- $L3 = 2 1.75 \times 9.5$ LVL (1.8E) + P3 ON BOTH SIDES
- * IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

POST TABLE:

P1 = 3" ADJUSTABLE STEEL COLUMN
P10 = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
POST BY USP
P2 = 2-224 OR 2-2x6
P3 = 3-2x4 OR 3-2x6

- P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (*)

- 13 6 3 6 3 6 3 6 5 6 7 6 2 4 7 6 7 6 7 6 7 6 7 6 7 6 7 6 7 6 7 7 6
- (*) = 2-12¢ ANCH. (WHERE ANCH. PL. NOT USED)
- * POST ARE ALL JACK c/w STUD
- (EX. P2 = 1 JACK + 1 STUD) * IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"



- SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:

 SHALL HAVE A VISUAL SIGNALING DEVICE;

 ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;

 ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

 ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND

 CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

2012 O.B.C. DRAWINGS

REV-1	NEW STANDARD DRWG MODIFICATION	13/11/2017	MAD
١0.	DESCRIPTION	DATE	BY

SECOND FLOOR - JOIST PLAN

SCALE: 3/16" = 1'-0" 1035 - THE MORROW

2020 FOOTPRINT

A11

XX/XX/XXXX