


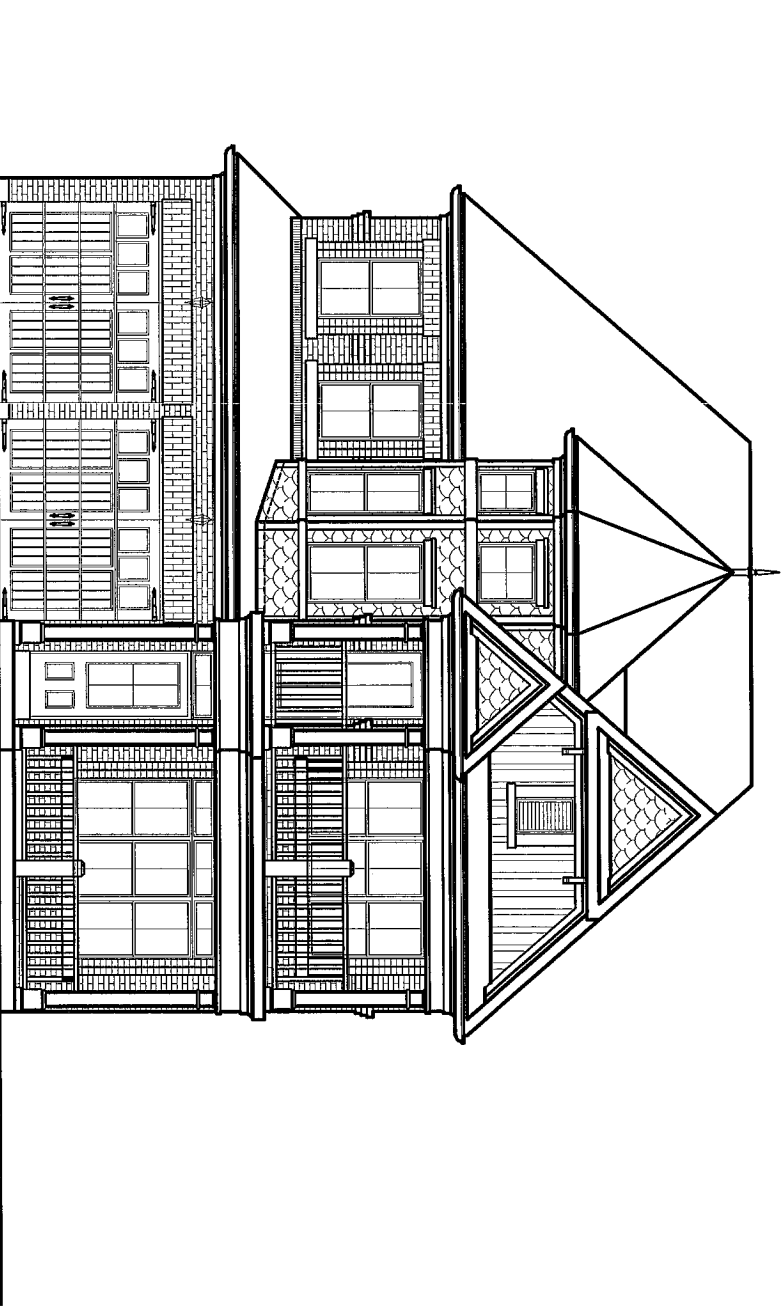


FRONT ELEVATION 'A'

DRAWING LIST:

43-6 (AMELIA)
(LOT 22A)

- T1 TITLE SHEET
- A1 BASEMENT FLOOR ELEV. 'A'
- A2 GROUND FLOOR ELEV. 'A'
- A3 SECOND FLOOR ELEV. 'A'
- A4 FRONT ELEVATION 'A'
- A5 RIGHT SIDE ELEVATION 'A'
- A6 REAR UPGRADE ELEVATION 'A'
- A7 LEFT SIDE ELEVATION 'A'
- E1 ELECTRICAL PLANS
- E2 ELECTRICAL PLANS
- D1 CONSTRUCTION SHEET
- D2 CONSTRUCTION SHEET
- D3 CONSTRUCTION SHEET

ZANCOR HOMES
OLDE WINCHESTER (PHASE 7)
BROOKLIN, ONTARIO



RN design
Imagine • Inspire • Create

CONTACT PERSON: ERIC SCHNEIDER

8395 JANE STREET
SUITE 203
VAUGHAN, ON
TEL: 905-738-3177
FAX: 905-738-5449

No.	REVISION COMMENTS:	DATE	DWN	CHK	No.	REVISION COMMENTS:	DATE	DWN	CHK	SCALE
1.	ISSUED FOR CLIENT REVIEW	AUG. 14/13	SLD	SH						AS NOTED
										PROJECT NO. 09014
										T1

THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS MUST BE OBTAINED BY THE CONTRACTOR PRIOR
TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES
MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.
REVISED: DECEMBER 17, 2007 - RN STAFF IN ACCORDANCE TO O.B.C. 2006


I, ERIC SCHNEIDER, DECLARE THAT I HAVE REVIEWED AND TRUE DESIGN
AND DESIGNER'S RESPONSIBILITY IS LIMITED
UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE
I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE
CLASSES/CATEGORIES

QUALIFIED DESIGNER BCIN: 30840
FIRM BCIN: 26995
DATE: JUNE 04, 2013

SIGNATURE:

This is the builder's complete responsibility to ensure that the plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Town of Whitby.




NOT FOR CONSTRUCTION

DATE: 2013-09-13

BY: [Signature]

FOR: [Signature]

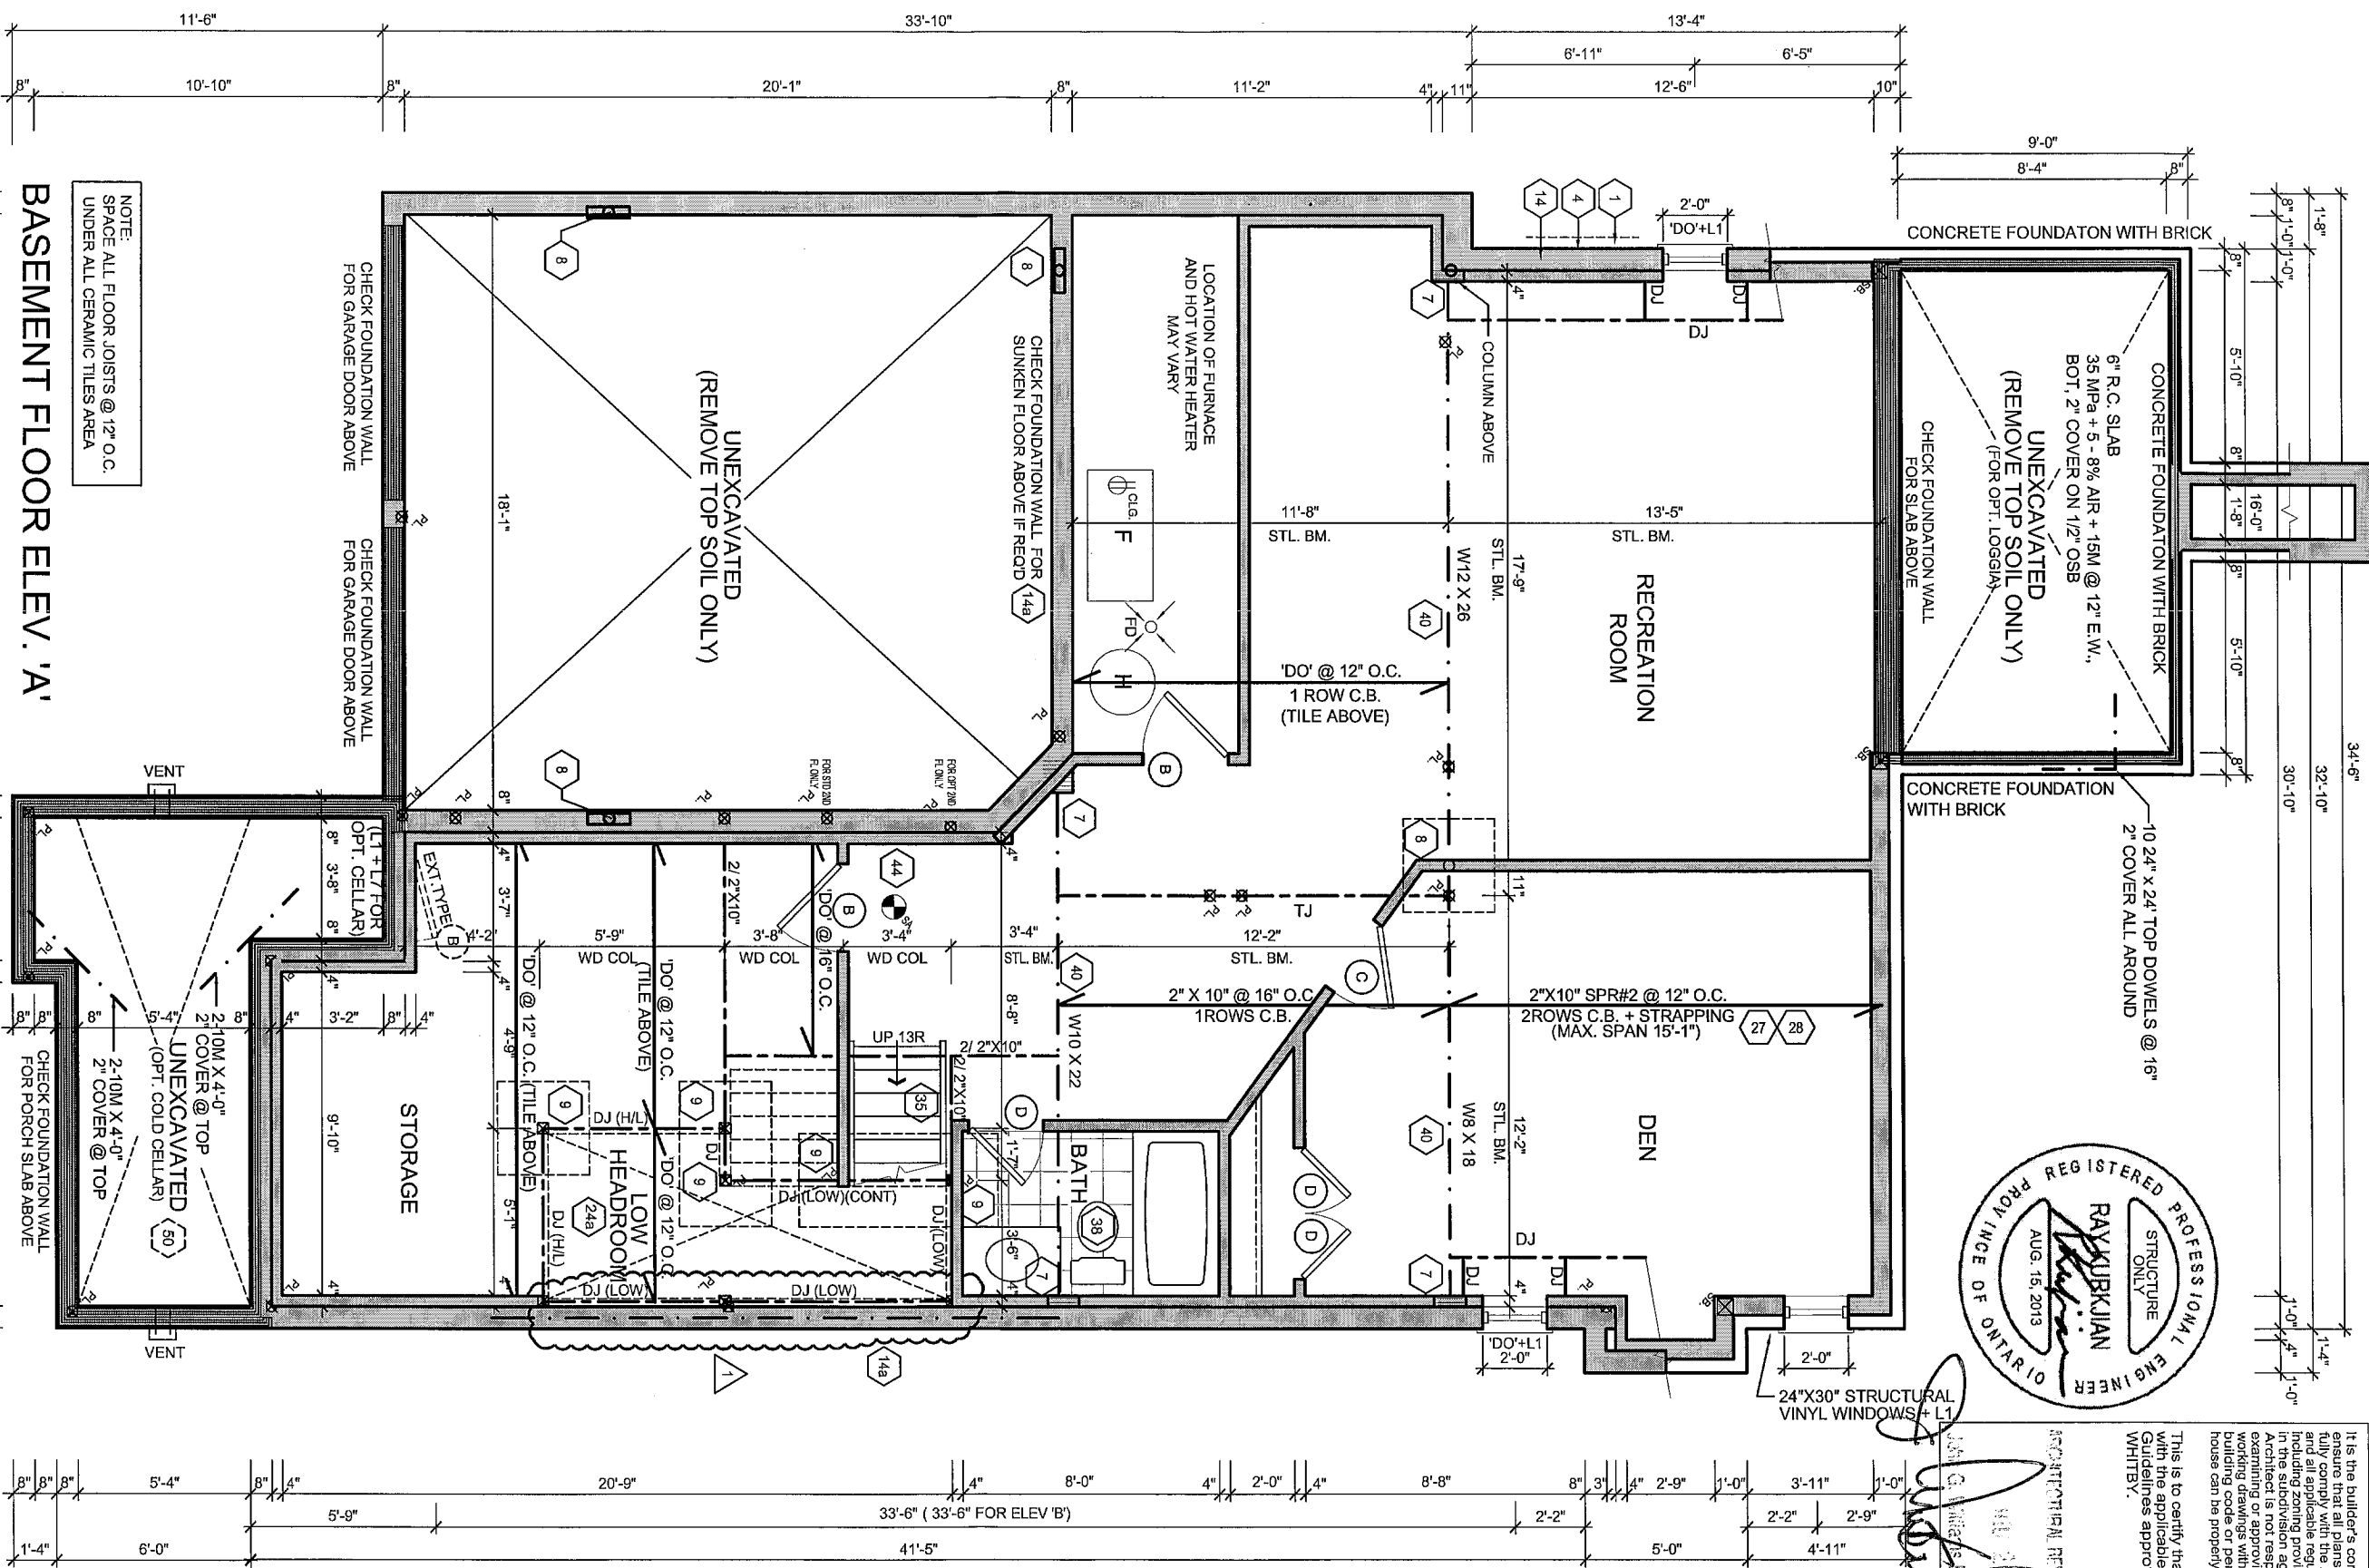

NOTE:
SPACE ALL FLOOR JOISTS @ 12" O.C.
UNDER ALL CERAMIC TILES AREA

BASEMENT FLOOR ELEV. 'A'

MODEL 43-6 (AMELIA) (LOT 22A)

CLIENT ZANCOR HOMES
OLDE WINCHESTER (PHASE 7)
BROOKLIN, ONTARIO

No. ISSUED OR REVISION COMMENTS				DATE	DWN	CHK	SCALE
1.	ISSUED FOR CLIENT REVIEW			AUG. 14/13	SJD	SH	3/16" = 1'0"
QUALIFIED DESIGNER BGIN: 30840				SIGNATURE: [Signature]			PROJECT NUMBER
FIRM BGIN: 26995				DATE: SEPTEMBER 20, 2010			09014
DATE: SEPTEMBER 20, 2010							PAGE
							A1

File C:\Users\Steven\AppData\Local\Temp\AcPublish_1524109014-43-06-FINAL.dwg Plotted: Aug 26, 2013 By: Steven H


OPTIONAL 10"x10" SQ VINYL POST ANCHORED TO JOIST/ BEAM BELOW (TYP.)

2"x6" CAP RAIL W/ 2"x2" PICKETS, MAX. 4" SPACING AS PER SB-7 SUPPLEMENTARY GUIDELINES TO THE OBC CAP RAIL HEIGHT TO BE 36" FROM DECK EXCEPT WHERE ADJACENT GRADE EXCEEDS 5'-1" THEN RAIL TO BE 42" HIGH

OPT. LOGGIA (CONCRETE) GT


APPROVED ROOF TRUSSES @ 2'-0" O.C.

4"x4" POSTS @ 47" O.C. MAX. ATTACHED TO JOISTS AS PER SB-7 SUPPLEMENTARY GUIDELINES TO THE OBC



It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code requirements. The Control Architect can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Town of Whitby.

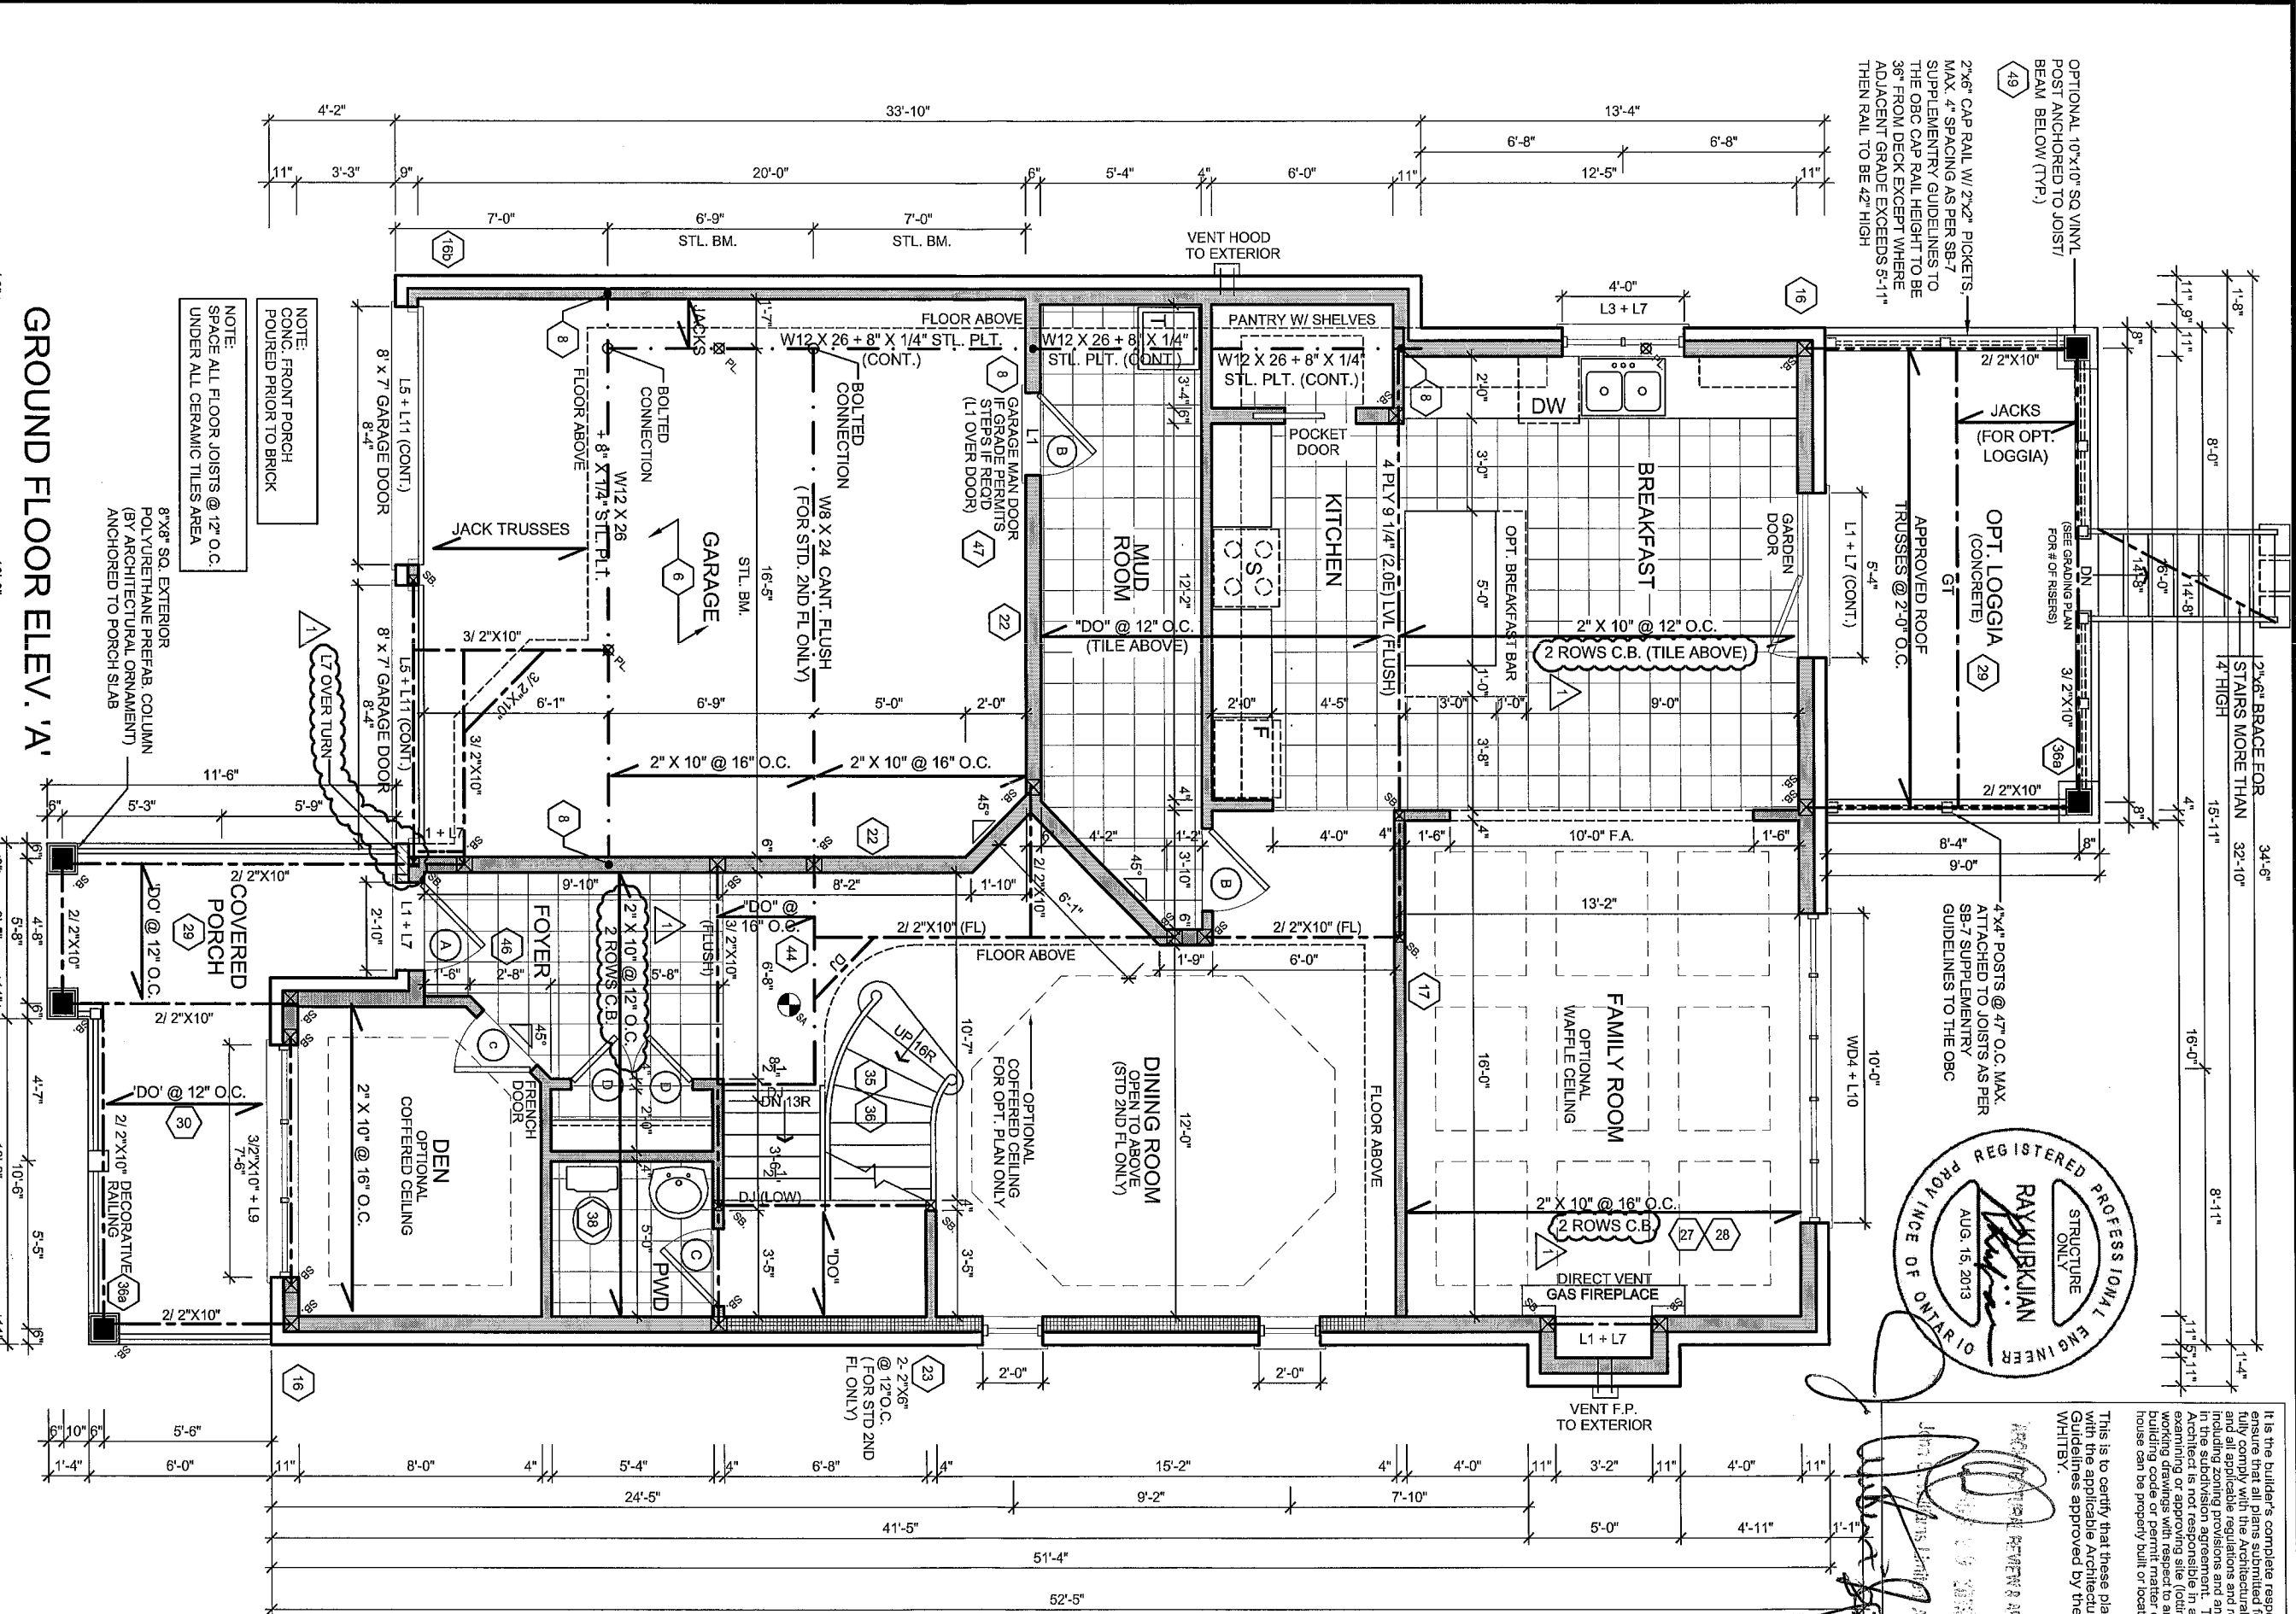

GROUND FLOOR ELEV. 'A'

43-6 (AMELIA) (LOT 22A)

ZANCOR HOMES
OLDE WINCHESTER (PHASE 7)
BROOKLIN, ONTARIO

THESE DRAWINGS ARE NOT TO BE SCALED
ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.
REVISED: DECEMBER 17, 2007 - RN STAFF IN ACCORDANCE TO O.B.C. 2006

1. REMOVED REAR PORCH THAT HAD BEEN DESIGNED AND THE DESIGN REVISIONS FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LIMITED UNDER DIVISION C, PART 3, SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSIFICATION.

QUALIFIED DESIGNER BCIN: 30840
FIRM BCIN: 26995
DATE: SEPTEMBER 20, 2010

SIGNATURE: *[Signature]*

SCALE: 3/16" = 1'0"
PROJECT NUMBER: 09014

A2




It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or building drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Town of Whitby.

NOT FOR CONSTRUCTION REVIEW & APPROVAL

[Signature]
DATE: SEP 14/13
BY: [Signature]

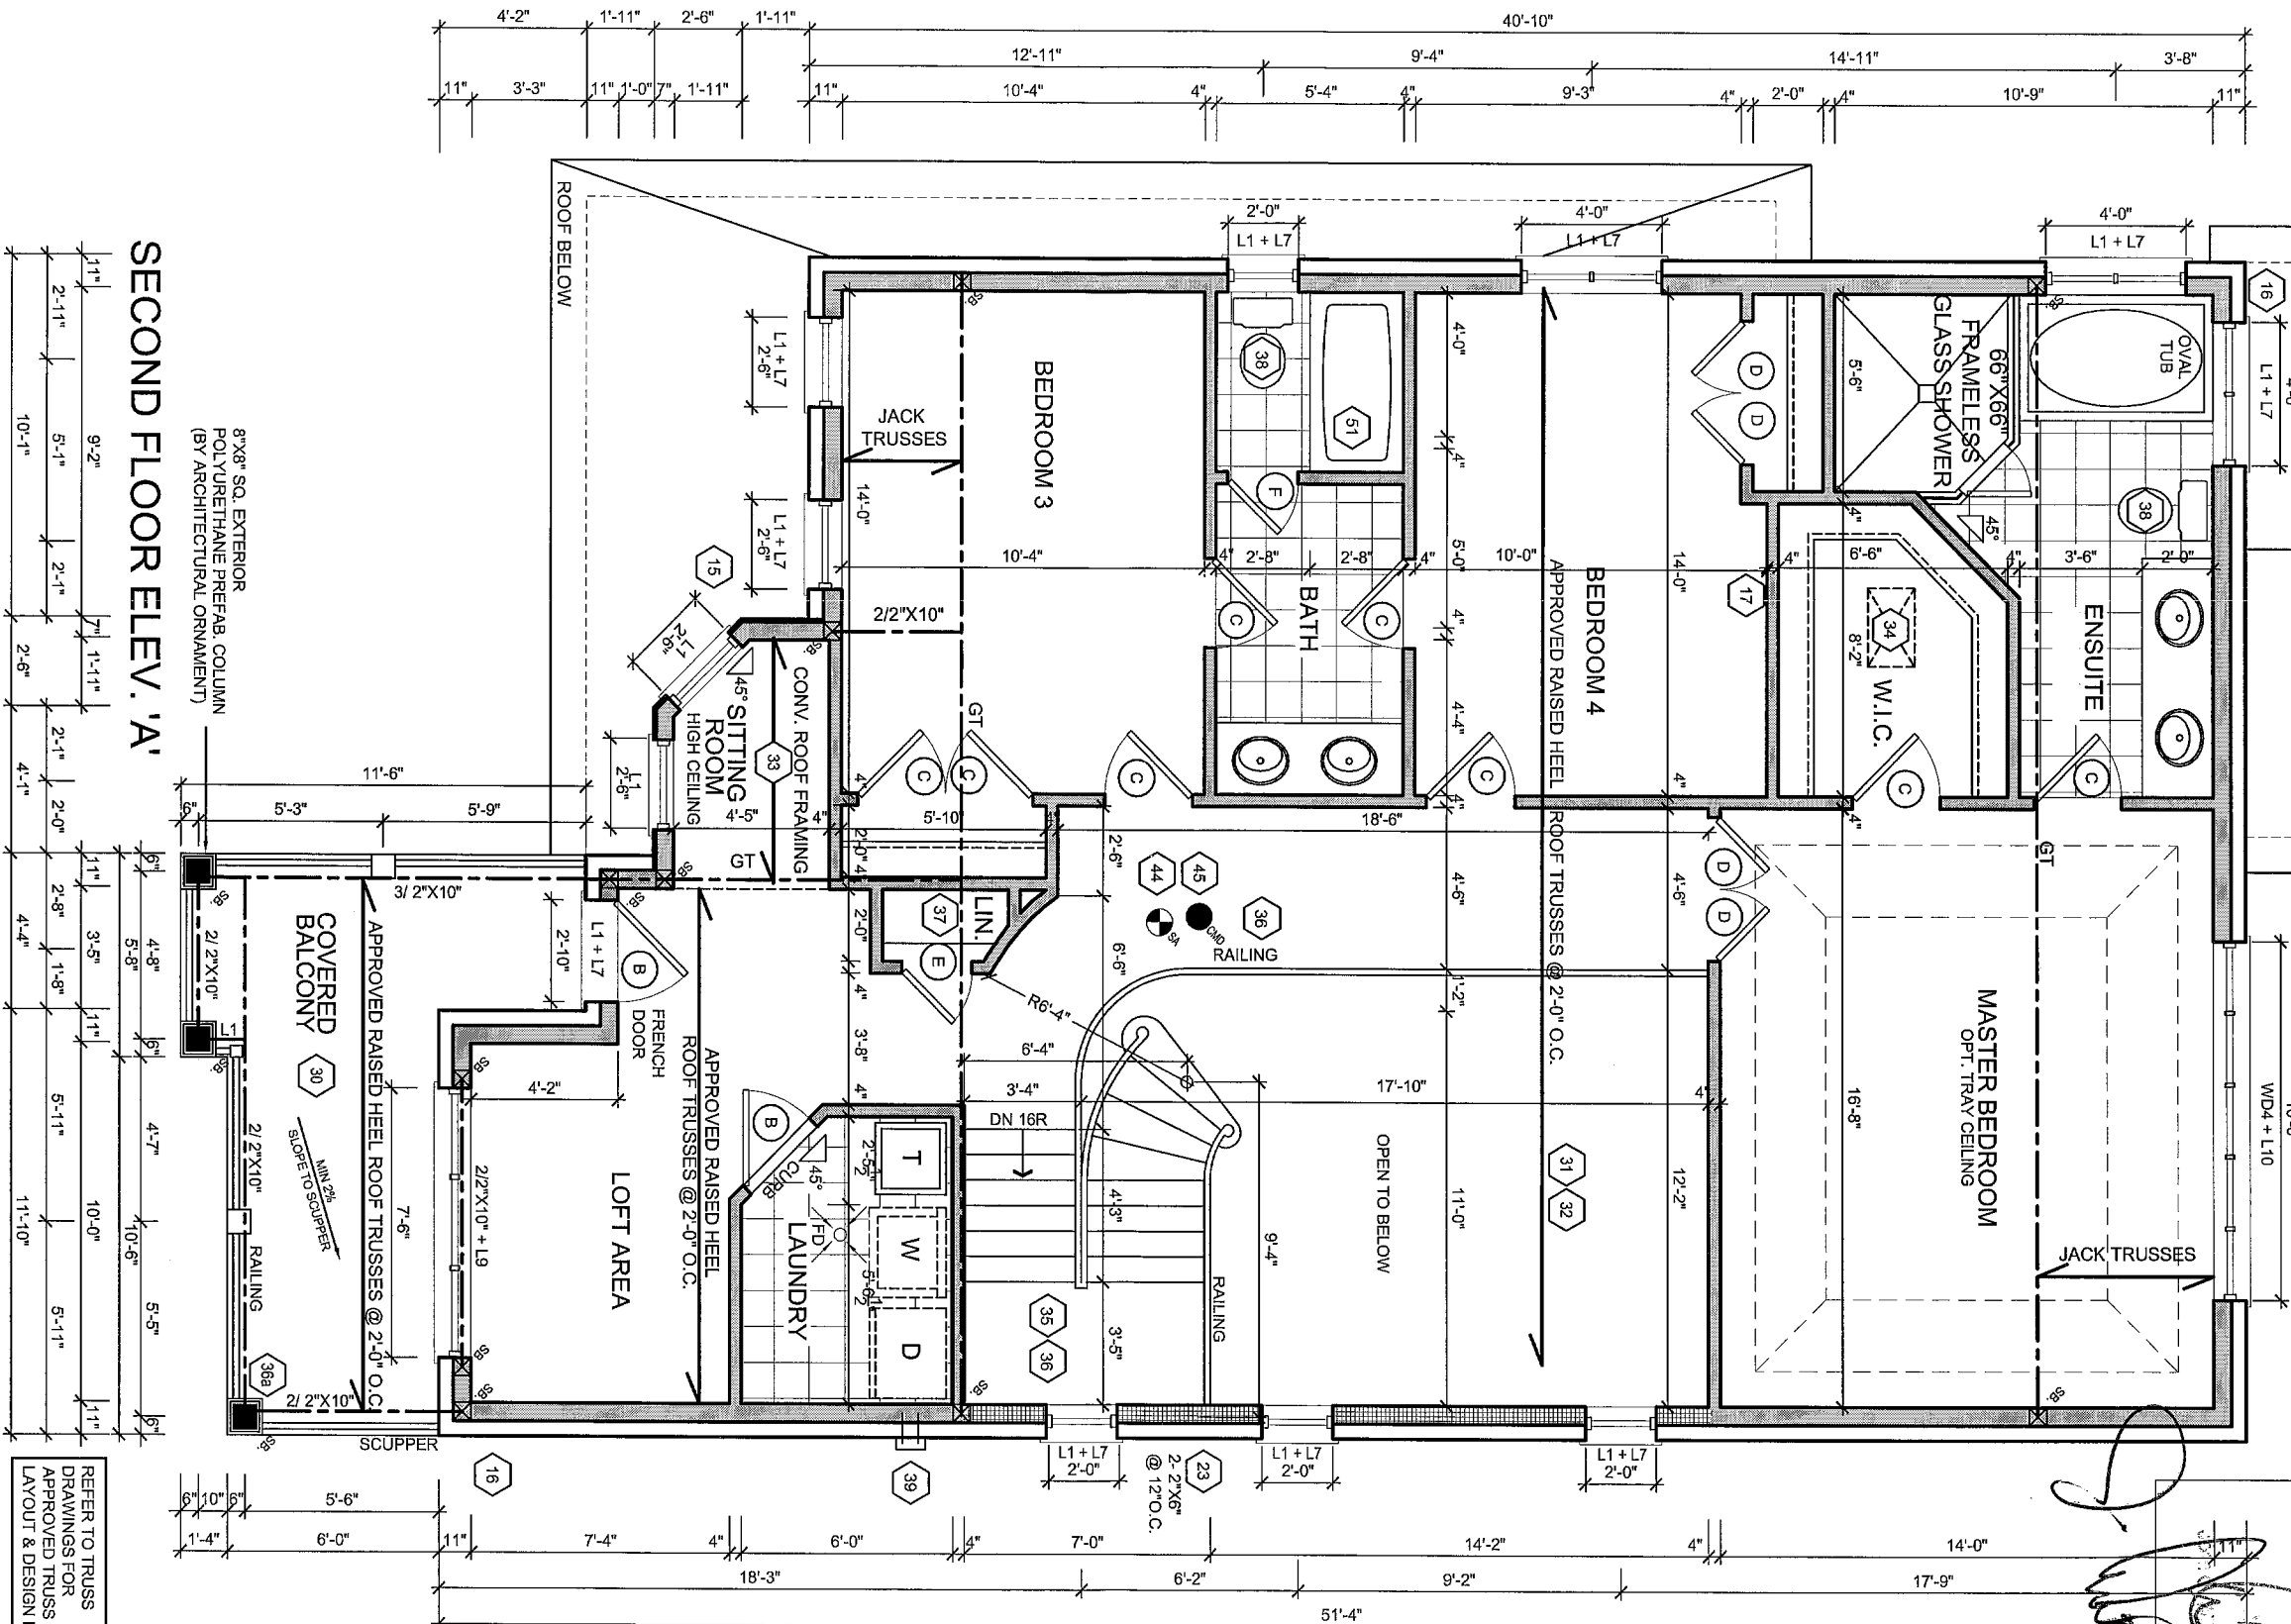


REFER TO TRUSS
DRAWINGS FOR
APPROVED TRUSS
LAYOUT & DESIGN LOADS

MODEL		No. ISSUED OR REVISION COMMENTS		DATE	DWN	CHK	SCALE
43-6 (AMELIA) (LOT 22A)		1.	ISSUED FOR CLIENT REVIEW	AUG. 14/13	SLD	SH	3/16" = 1'0"
CLIENT						PROJECT NUMBER	
ZANCOR HOMES OLDE WINCHESTER (PHASE 7) BROOKLIN, ONTARIO						09014	
						PAGE	
						A3	

THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.
REVISED: DECEMBER 17, 2007 - RN STAFF IN ACCORDANCE TO O.B.C. 2006


I, RAY KURKIJIAN, REGISTERED PROFESSIONAL ENGINEER, STRUCTURE ONLY, ONTARIO, AUG. 15, 2013, HEREBY CERTIFY THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE SECOND FLOOR PLAN OF THE BUILDING CODE UNDER DIVISION C PART 3, SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES/CATEGORIES.

QUALIFIED DESIGNER BCIN: 30840 SIGNATURE: *[Signature]*
FIRM BCIN: 26995
DATE: SEPTEMBER 20, 2010

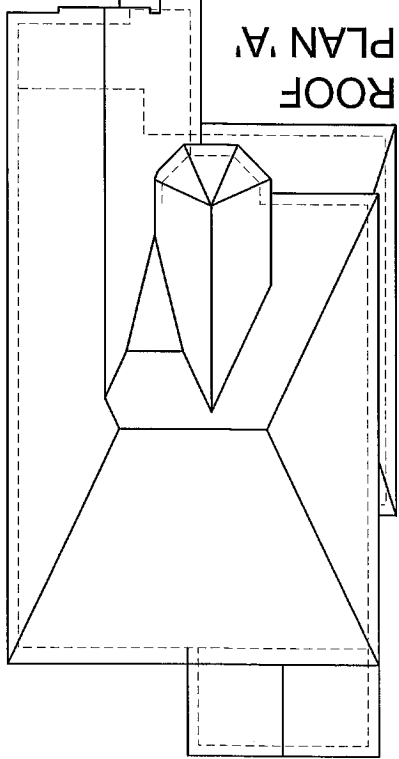

ALL CONVENTIONAL ROOF FRAMING TO CONFORM TO PART 9 OF THE OBC. ROOF RAFTERS THAT MEET OR CROSS OVER TRUSSES ARE TO BE 2"x4" SPF @ 24" o.c. WITH A 2"x4" SPF VERTICAL POST TO THE TRUSS UNDER, AT EACH CROSS POINT. POSTS LONGER THAN 6' TO BE Laterally Braced so that the distance between end points & between rows of bracing does not exceed 6'.

REFER TO TRUSS DRAWINGS FOR APPROVED TRUSS LAYOUT.

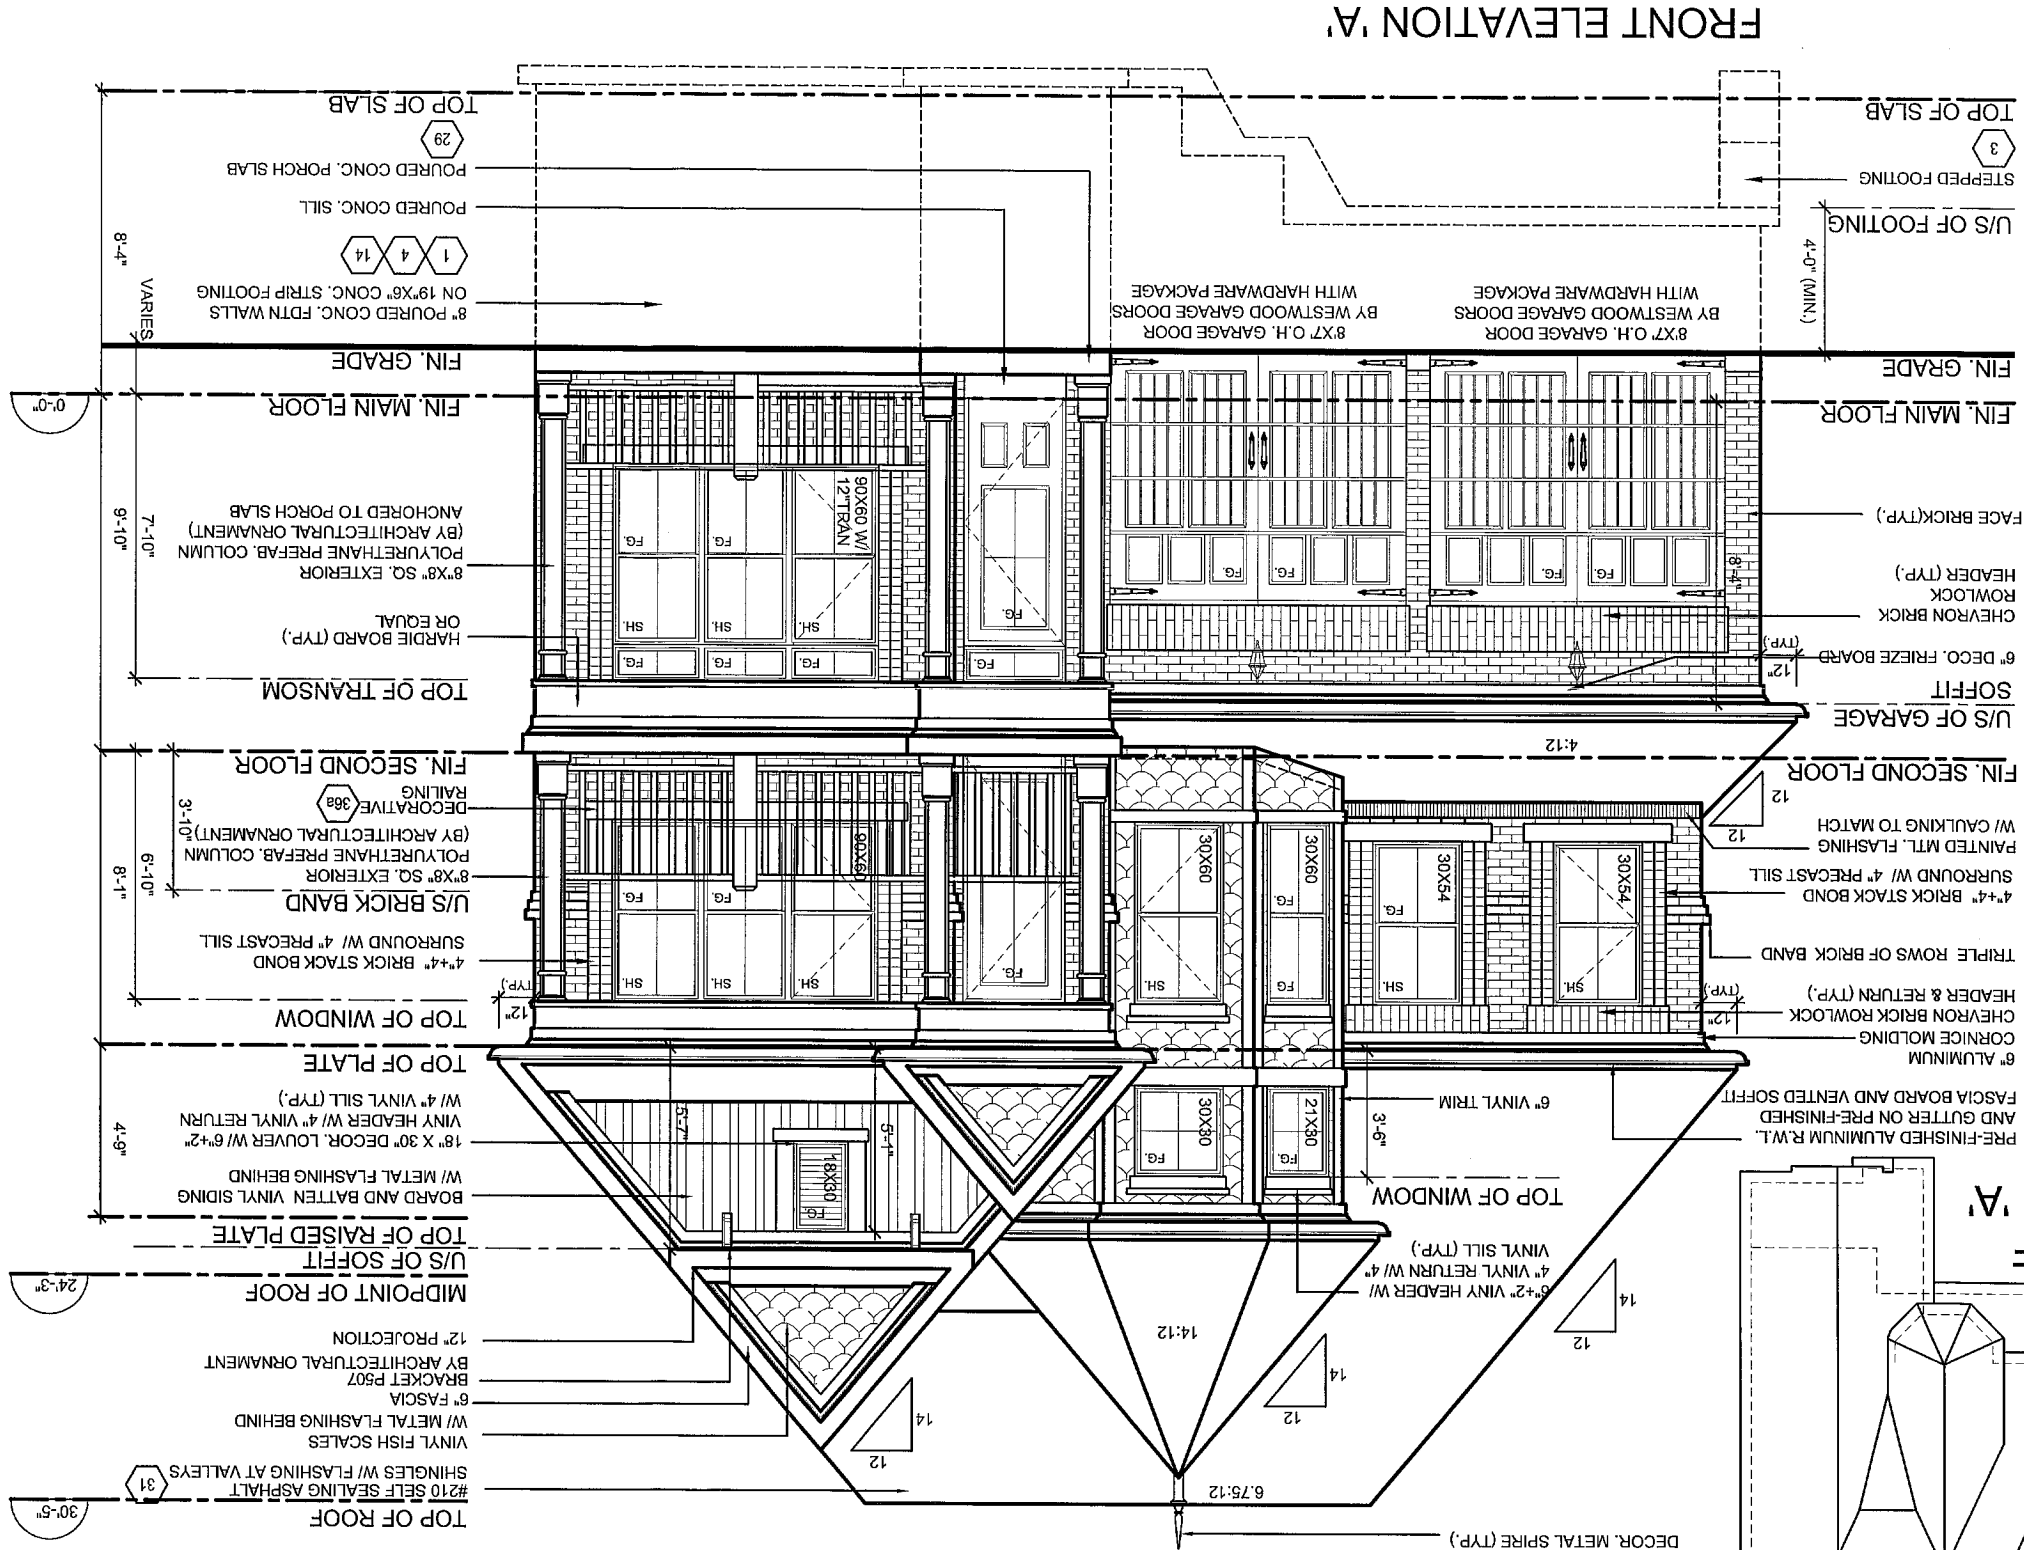

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines including zoning regulations and requirements in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot. This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Town of Whitby.

APPROVED BY ARCHITECTURAL DESIGNER
DATE: 2010-07-14
SIGNATURE: [Signature]

Handwritten signature and date: 2010-07-14

43-6 (AMELIA) (LOT 22A)

MODEL

ZANCOR HOMES
OLDE WINCHESTER (PHASE 7)
BROOKLIN, ONTARIO

PN design
Imagine • Inspire • Create
TEL: (905) 739-3177
FAX: (905) 739-5449

THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS ARE TO FACE UNLESS NOTED OTHERWISE.
NO DIMENSIONS ARE TO BE USED FOR CONSTRUCTION PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO PN DESIGN LTD.
REVISED: DECEMBER 17, 2007 - PN STAFF IN ACCORDANCE TO O.B.C. 2006

1. ERIC SCHNEIDER, DECLARE THAT I HAVE REVIEWED AND MADE DESIGN CHANGES TO THESE DRAWINGS.
I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSES/CATEGORIES.

QUALIFIED DESIGNER BCIN: 30840
FIRM BCIN: 28995
DATE: SEPTEMBER 20, 2010

SIGNATURE: [Signature]


NO. ISSUED OR REVISION COMMENTS

DATE DWN CHK

SCALE
3/16" = 1'0"

PROJECT NUMBER
09014

REAR UPGRADE ELEVATION 'A'
LOOK OUT BASEMENT CONDITION

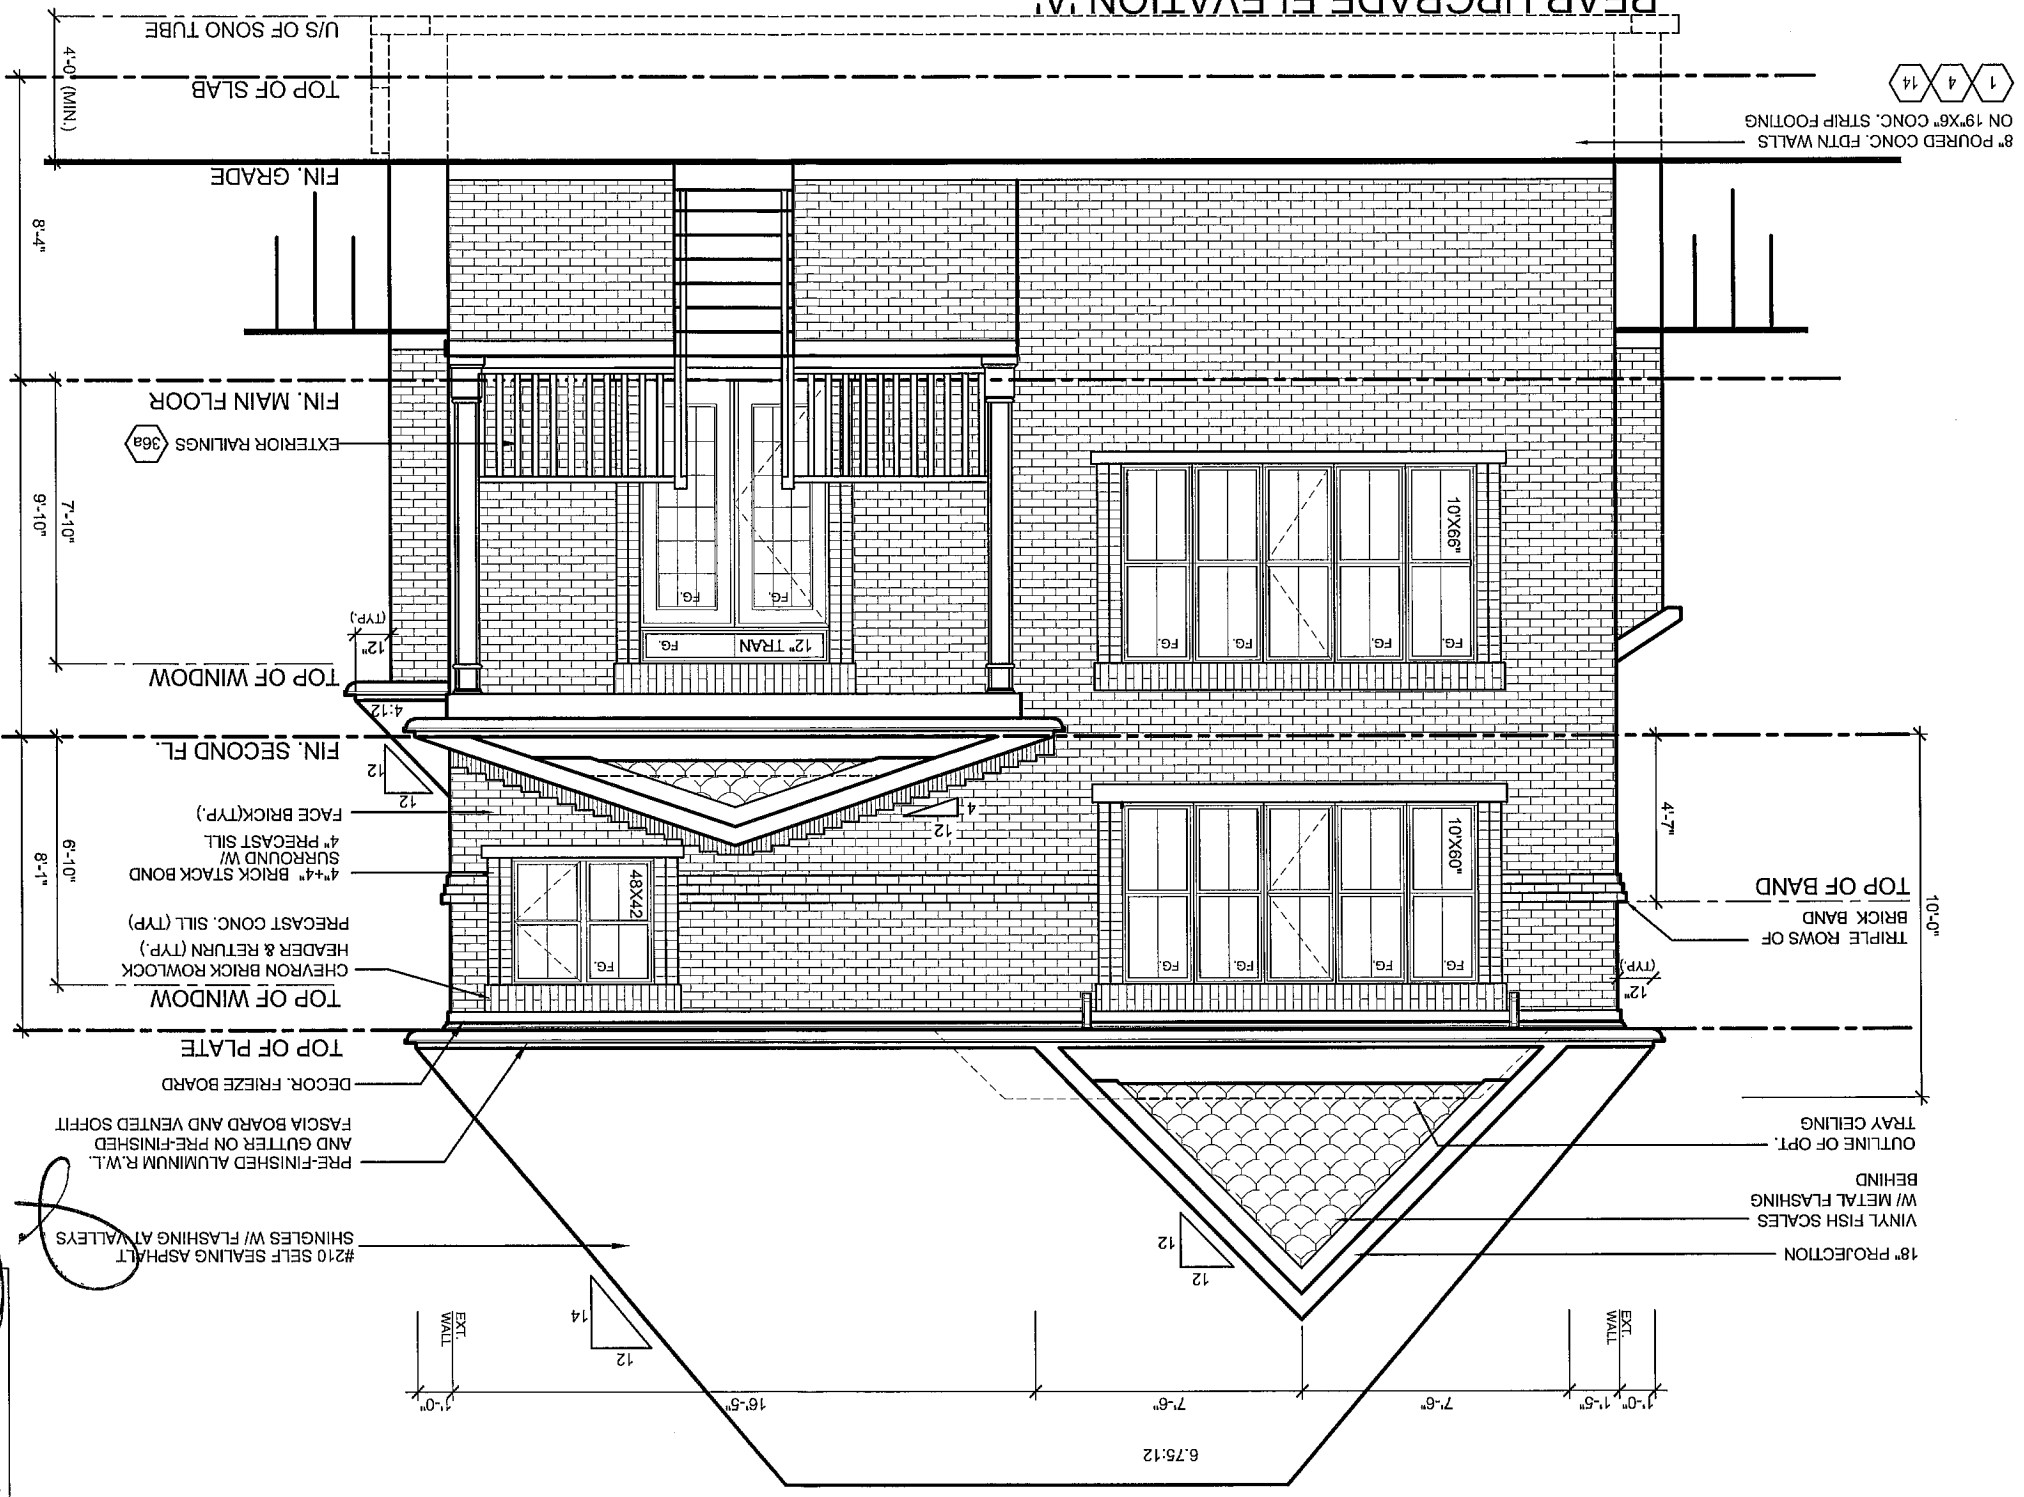

1 4 14
8" POURED CONC. FDTN WALLS
ON 19"X6" CONC. STRIP FOOTING

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot. This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Town of WHITBY.

ARCHITECTURAL REVIEW & APPROVAL
J. O. Williams Limited, Architect
14 SEP 2010

MODEL		43-6 (AMELIA) (LOT 22A)			
No.	ISSUED OR REVISION COMMENTS	DATE	DWN	CHK	SCALE
	ISSUED FOR CLIENT REVIEW				
1.		AUG. 14/13	SLD	SH	3/16" = 1'0"

FN design
Imagine • Inspire • Create
TEL: (905) 738-3177
FAX: (905) 738-5449

ZANCOR HOMES
OLDE WINCHESTER (PHASE 7)
BROOKLIN, ONTARIO

THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS ARE TO FACE UNLESS NOTED OTHERWISE.
TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES
MUST BE REPORTED DIRECTLY TO FN DESIGN LTD.
REVISED: DECEMBER 17, 2007 - FN STAFF IN ACCORDANCE TO O.B.C. 2006

DESIGNER: J. O. Williams Limited, Architect
FIRM BCIN: 26995
DATE: SEPTEMBER 20, 2010

SIGNATURE: *[Signature]*


PAGE
A6

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Town of WHITBY.

ARCHITECTURAL REVIEW APPROVAL
J. G. WILSON LIMITED
J. G. WILSON

John G. Wilson
Sept. 12/13

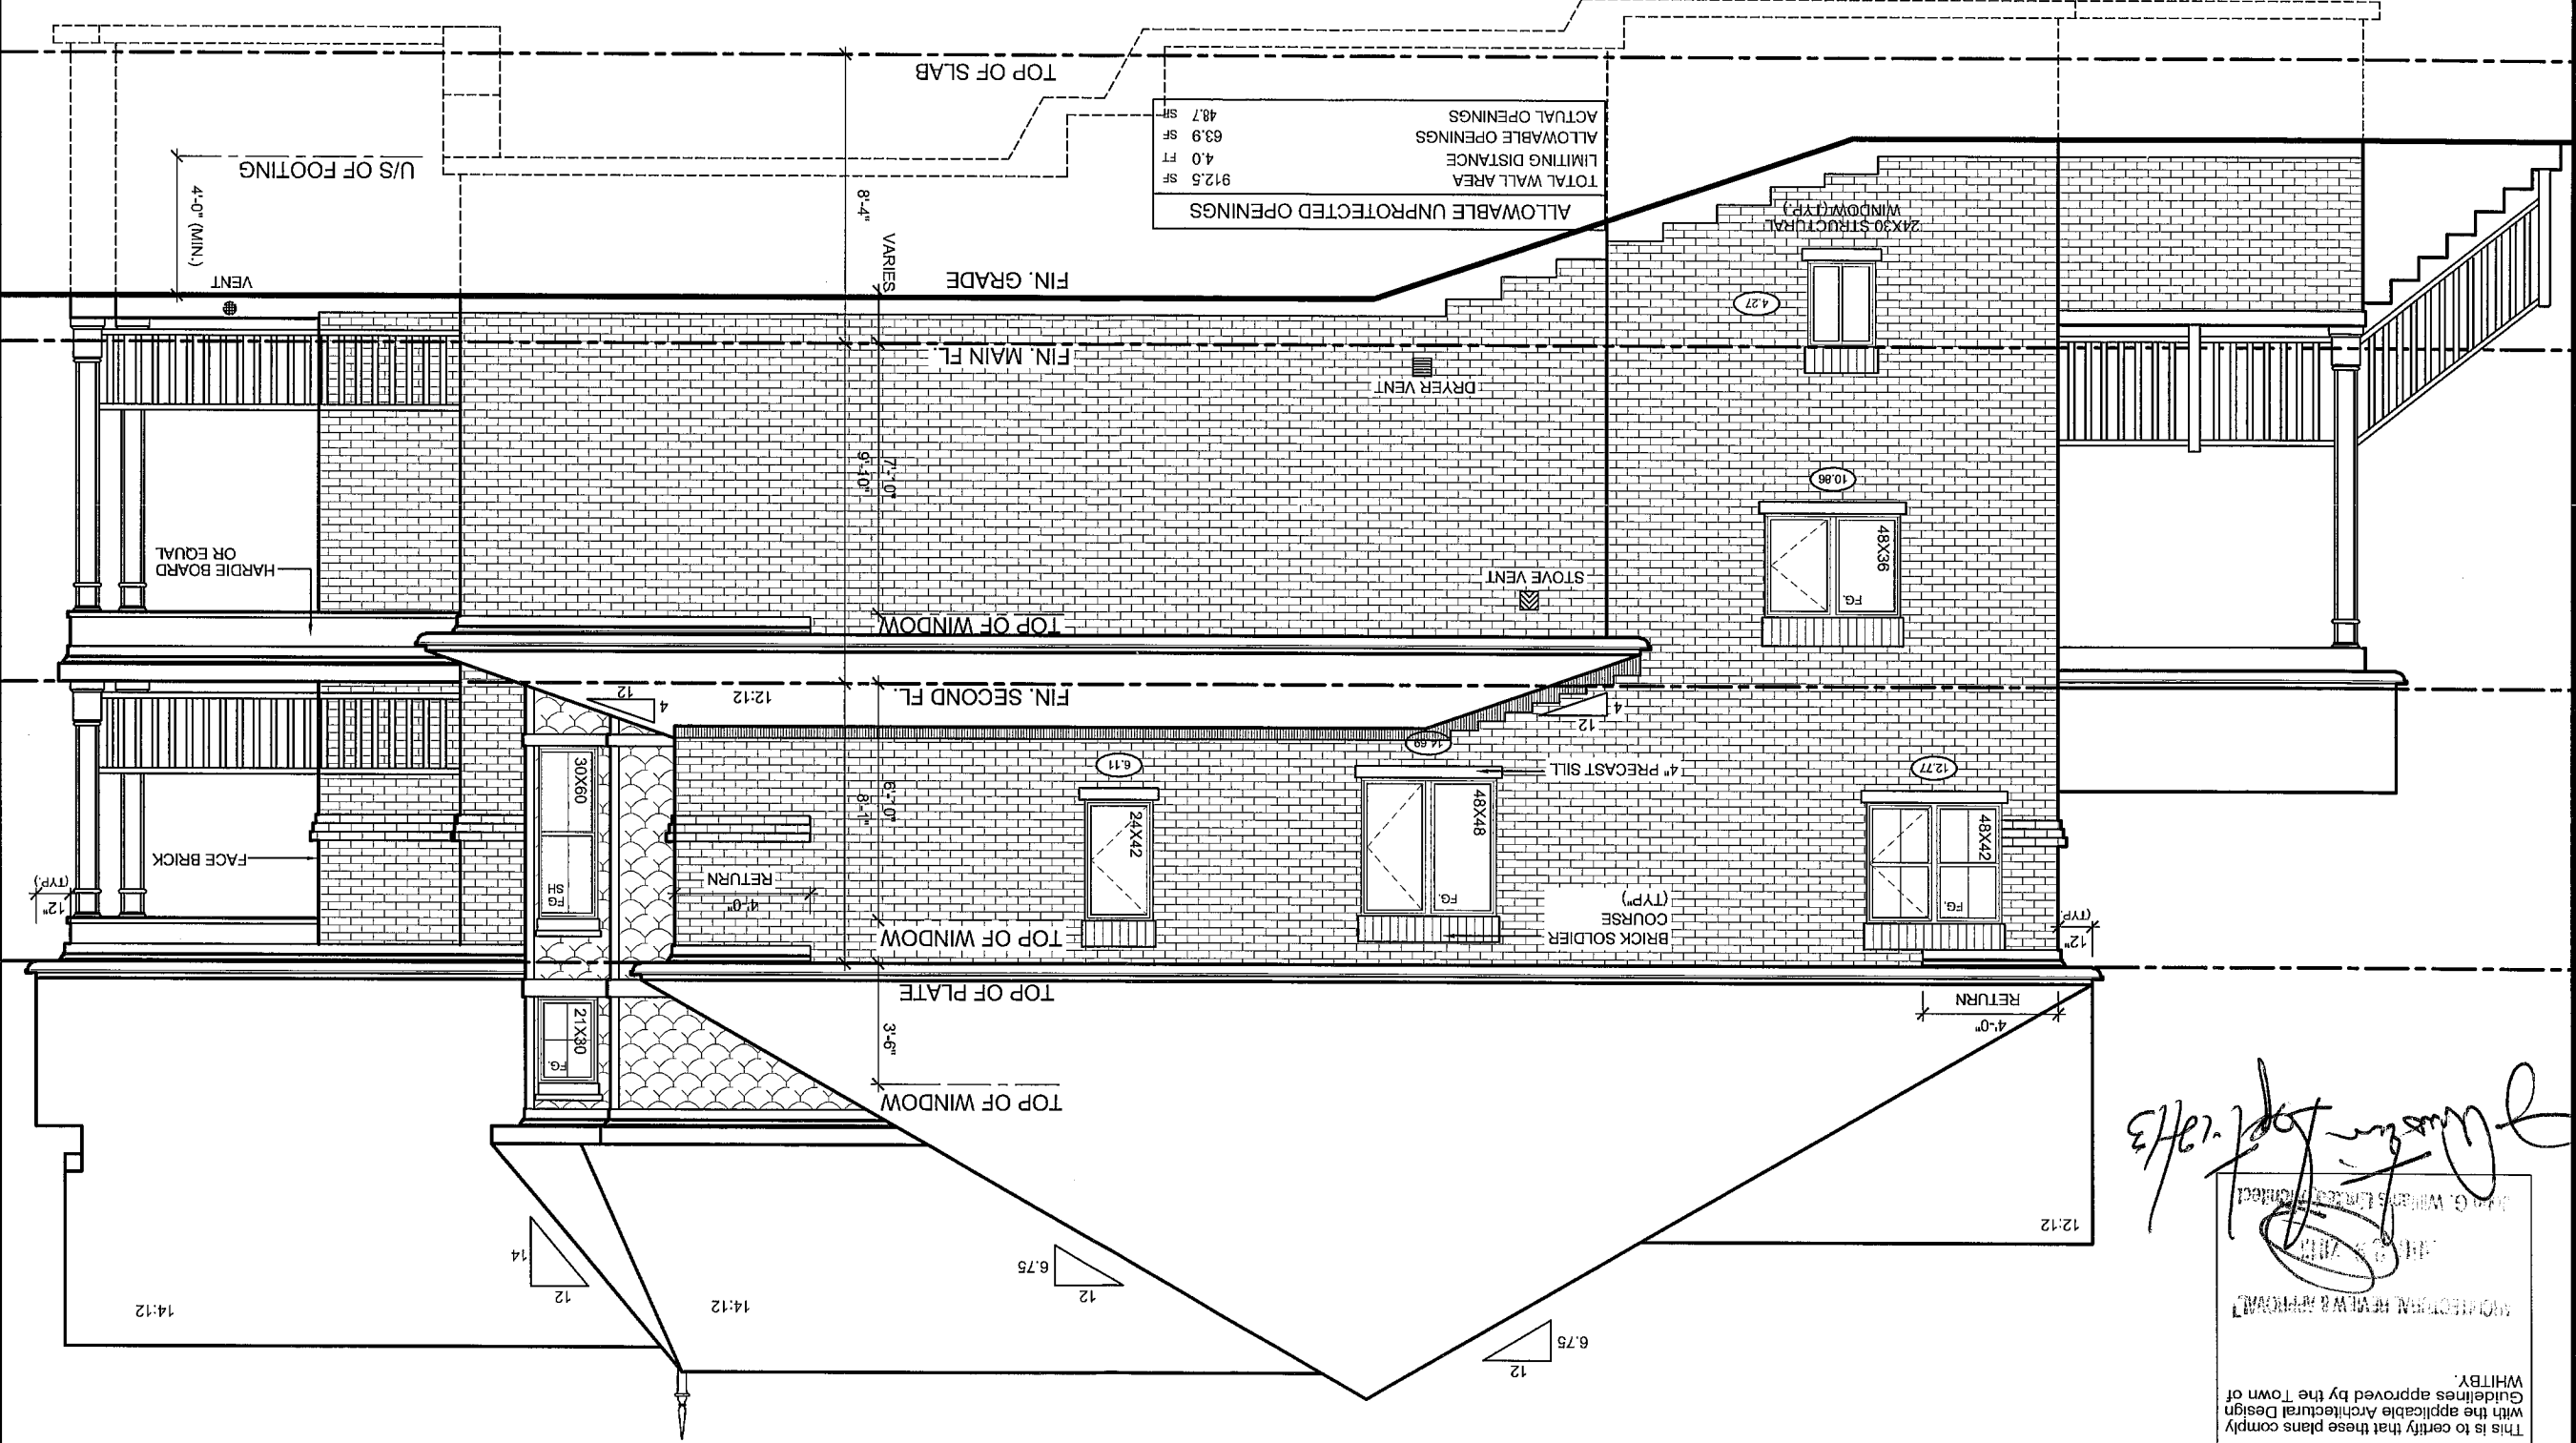

ALLOWABLE UNPROTECTED OPENINGS	912.5 SF
LIMITING DISTANCE	4.0 FT
ALLOWABLE OPENINGS	63.9 SF
ACTUAL OPENINGS	48.7 SF

MODEL	43-6 (AMELIA) (LOT 22A)	No. ISSUED OR REVISION COMMENTS	DATE	DWN	CHK	SCALE
CLIENT	ZANCOR HOMES OLDE WINCHESTER (PHASE 7) BROOKLIN, ONTARIO	1. ISSUED FOR CLIENT REVIEW	AUG. 14/13	SLD	SH	3/16" = 1'0"
						PROJECT NUMBER 09014
						PAGE A7





RN design
Imagine • Inspire • Create
TEL: (905) 738-3177
FAX: (905) 738-5449


THESE DRAWINGS ARE NOT TO BE SCALED.
THESE DRAWINGS HAVE BEEN PREPARED BY AN ARCHITECT PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.
REVISED: DECEMBER 17, 2007 - RN STAFF IN ACCORDANCE TO O.A.C. 2006

ERIC SCHNEIDER, DECARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THESE DRAWINGS. I AM A LIMITED USER DIVISION C PART 3 SUBSECTION 2.2.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSES/CATEGORIES.

QUALIFIED DESIGNER BCIN: 30840
FIRM BCIN: 26995
DATE: SEPTEMBER 20, 2010
SIGNATURE: *Eric Schneider*

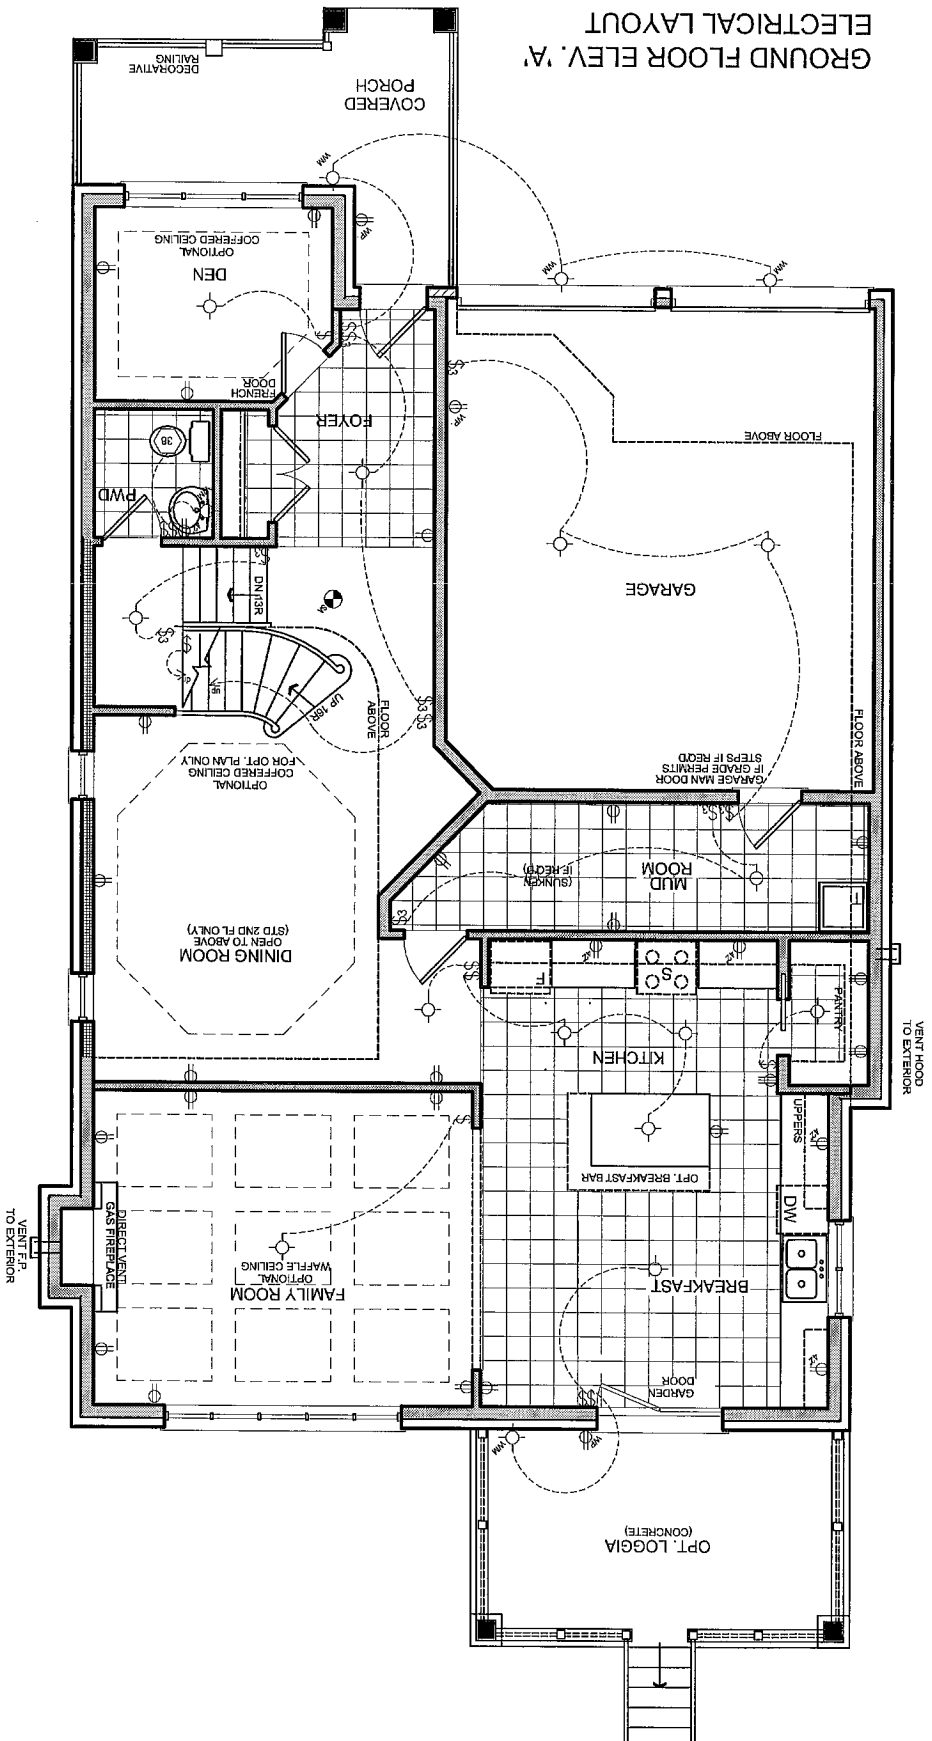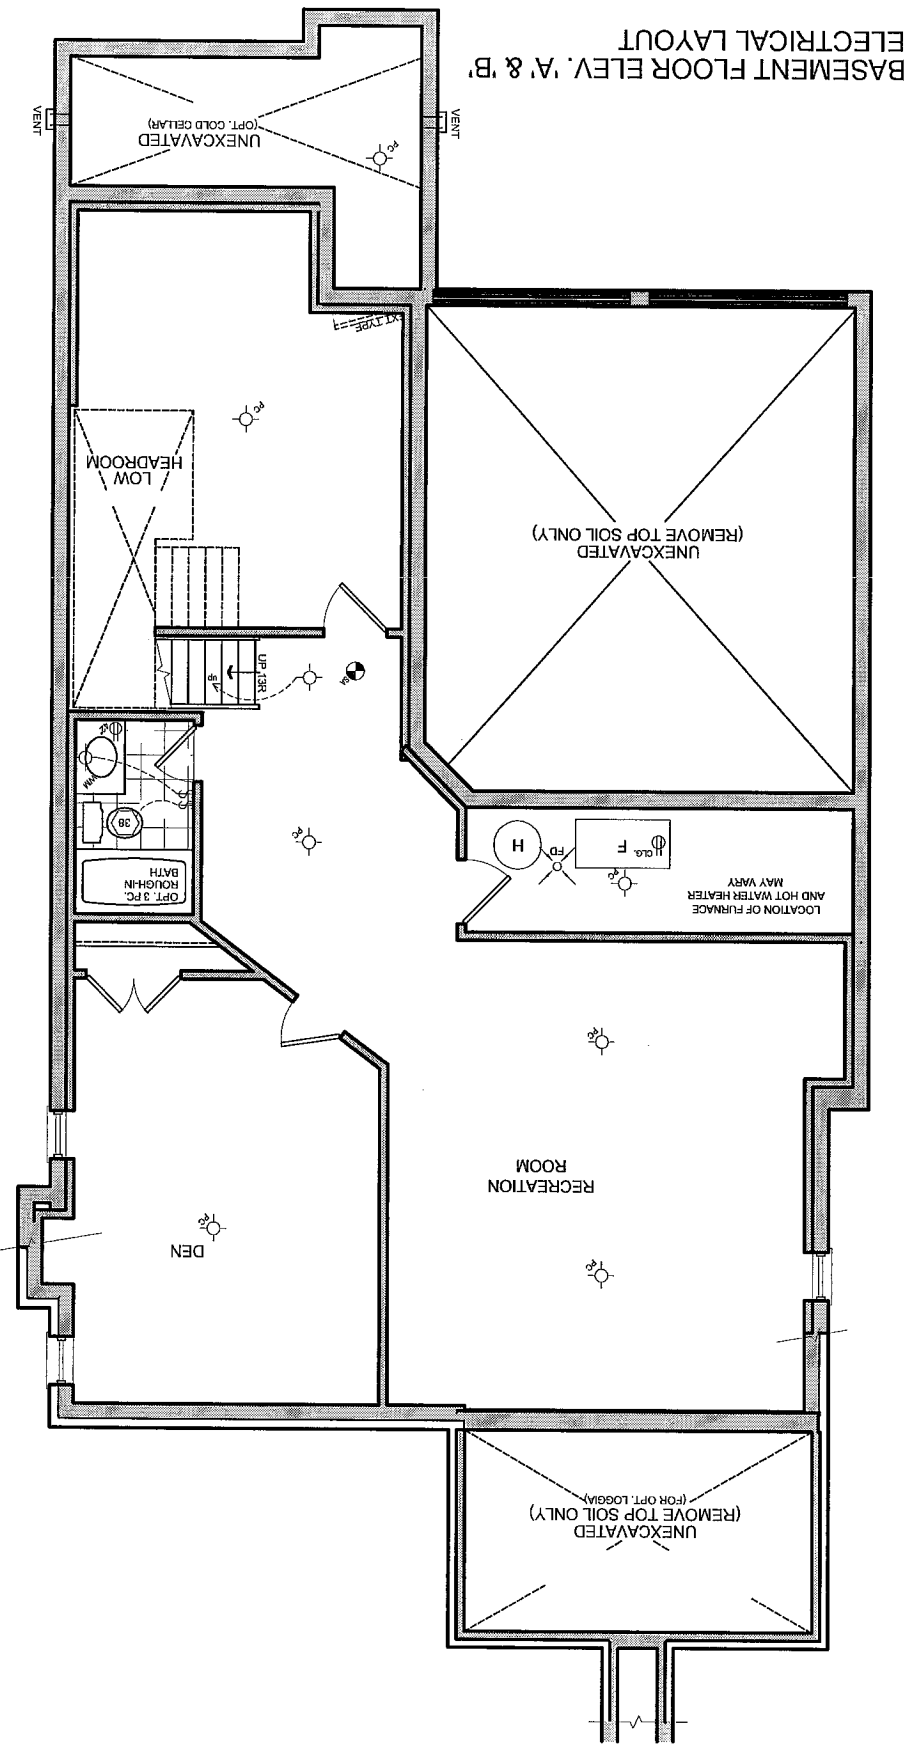

 RN design <i>Imagine - Inspire - Create</i> Tel: (905) 738-5449 Fax: (905) 738-5449	MODEL	43-6 (AMELIA) (LOT 22A)			
	CLIENT	ZANCOR HOMES OLDE WINCHESTER (PHASE 7) BROOKLIN, ONTARIO			
THESE DRAWINGS ARE NOT TO BE SCALED. THESE DRAWINGS ARE FOR INFORMATION ONLY. TO COMPLY WITH THE REQUIREMENTS OF THE MUST BE REPORTED DIRECTLY TO RN DESIGN LTD. REVISED: DECEMBER 17, 2007 - RN STAFF IN ACCORDANCE TO O.B.C. 2008	No. ISSUED OR REVISION COMMENTS	DATE	DWN	CHK	SCALE
					1/8" = 1'0"
1. ERIC SCHNEIDER, DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LIMITED (I AM QUALIFIED AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSES/CATEGORIES).	1. ISSUED FOR CLIENT REVIEW	AUG. 14/13	SLD	SH	PROJECT NUMBER
					09014
QUALIFIED DESIGNER BCIN: 30840	SIGNATURE:	PAGE			
FIRM BCIN: 26995	DATE: SEPTEMBER 20, 2010	E1			

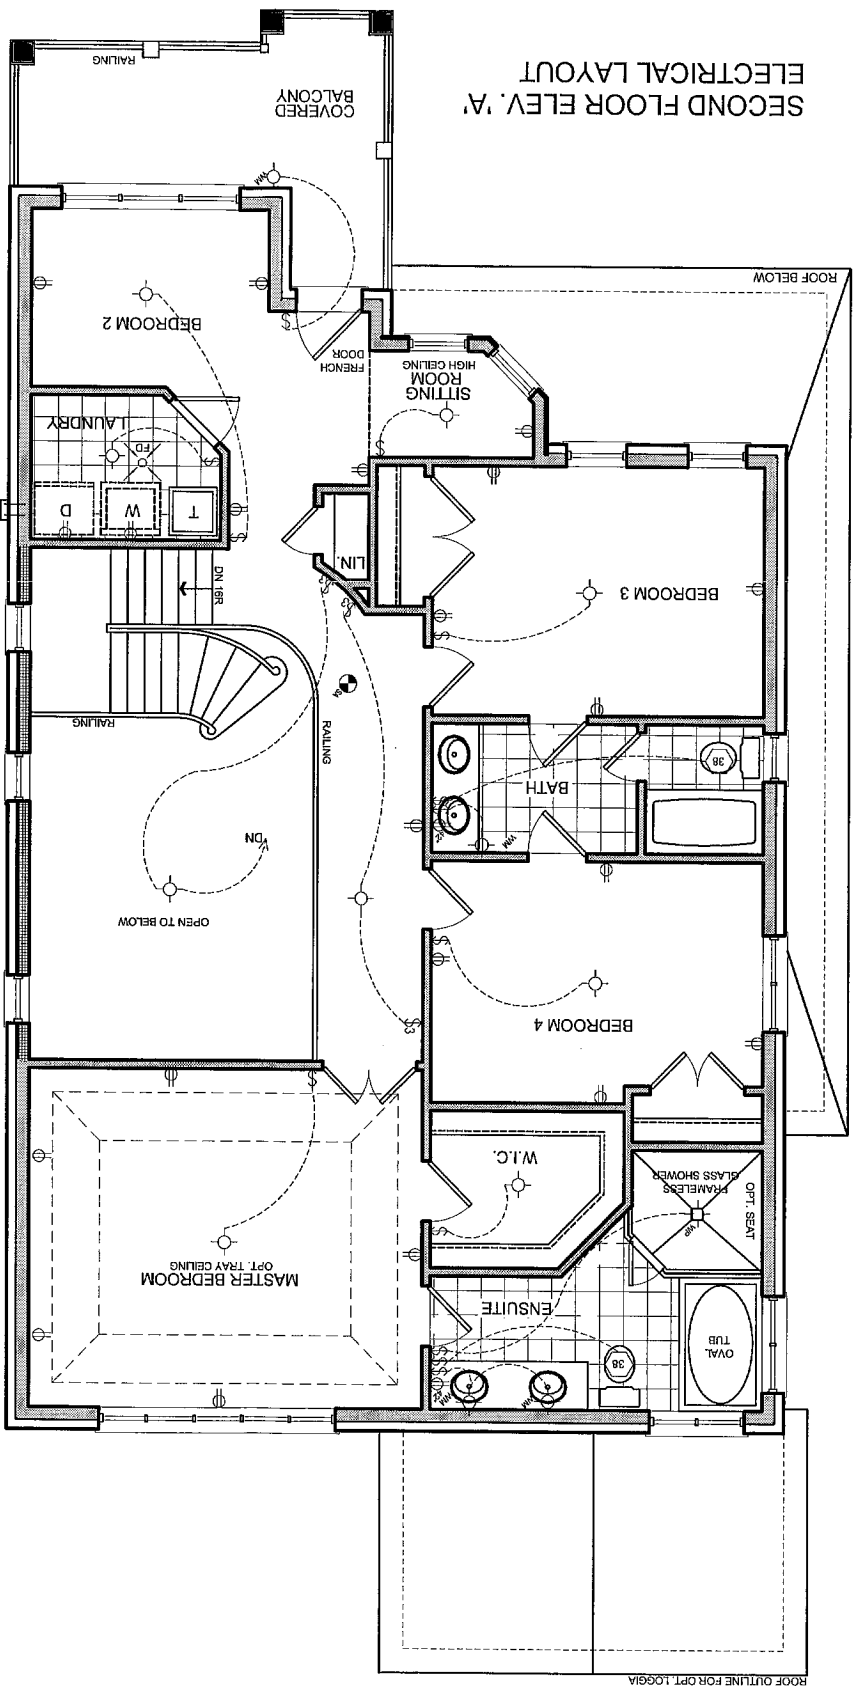

SECOND FLOOR ELEV. 'A'
ELECTRICAL LAYOUT



RN design
Imagine • Inspire • Create
TEL: (905) 738-3177
FAX: (905) 738-5449

THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS MUST BE OBTAINED FROM THE DRAWINGS.
TO COMMENCEMENT OF ANY WORK, ANY DISCREPANCIES
MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.
REVISED: DECEMBER 17, 2007 - RN STAFF IN ACCORDANCE TO O.B.C. 2006

I, ERIC SCHNEIDER, DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN
RESPONSIBILITY FOR THE DESIGNATION ON BEHALF OF RN DESIGN LIMITED.
I AM QUALIFIED AND THE FIRM IS REGISTERED, IN THE APPROPRIATE
CLASSIFICATION CATEGORIES.

QUALIFIED DESIGNER BCIN: 30840
FIRM BCIN: 28995
DATE: SEPTEMBER 20, 2010

SIGNATURE: *Eric Schneider*

MODEL		No. ISSUED OR REVISION COMMENTS				DATE	DWN	CHK	SCALE
43-6 (AMELIA) (LOT 22A)		1.	ISSUED FOR CLIENT REVIEW			AUG. 14/13	SLD	SH	1/8" = 1'0"

CLIENT		PROJECT NUMBER						
ZANCOR HOMES OLDE WINCHESTER (PHASE 7) BROOKLIN, ONTARIO		09014						

PAGE

E2

CONSTRUCTION NOTES:

COMPLIANCE PACKAGE J

(UNLESS OTHERWISE NOTED)
-ALL CONSTRUCTION TO CONFORM TO THE ONTARIO BUILDING CODE (O.B.C.) AND ALL OTHER CODES AND LOCAL AUTHORITIES HAVING JURISDICTION.
-ALL DIMENSIONS GIVEN FIRST IN IMPERIAL, FOLLOWED BY METRIC.
-THERMAL RESISTANCE VALUES BASED ON ZONE 1

FOOTINGS / SLABS:

TYPICAL STRIP FOOTING:

O.B.C. 9.15.3.

-BASED ON 16'-1 1/4" (491mm) MAX. SUPPORTED JOIST LENGTH
-MIN. 2200psi (15MPa) CONCRETE AFTER 28 DAYS
-SHALL REST ON UNDISTURBED SOIL, ROCK OR COMPACTED GRANULAR FILL W/ MIN. 10.9psi (75kPa) BEARING CAPACITY
-FTG. TO HAVE CONTINUOUS KEY
-FTG. SIZES MAY BE REDUCED FOR SOILS W/ GREATER BEARING CAPACITY (AS PER SOILS ENGINEERING REPORT)

1 TYPICAL STRIP FOOTING: (EXTERIOR WALLS)

O.B.C. 9.15.3.5.

-FTG. TO EXTEND MIN. 4'-0" (1200mm) BELOW GRADE
BRICK VENEER - 1" STOREY - 13" X 4" (330mm X 100mm)
-2 STOREY - 19" X 6" (485mm X 155mm)
-3 STOREY - 26" X 8" (660mm X 230mm)

SIDING:

-1 STOREY - 1" X 4" (255mm X 100mm)
-2 STOREY - 1 1/4" X 4" (360mm X 100mm)
-3 STOREY - 1 1/2" X 5" (460mm X 130mm)

2 TYPICAL STRIP FOOTING: (INTERIOR BEARING WALLS)

O.B.C. 9.15.3.6.

-1 STOREY MASONRY - 16" X 4" (410mm X 100mm)
-1 STOREY STUD - 12" X 4" (305mm X 100mm)
-2 STOREY MASONRY - 26" X 6" (650mm X 230mm)
-2 STOREY STUD - 16" X 5" (450mm X 130mm)
-3 STOREY MASONRY - 36" X 1 1/4" (900mm X 360mm)
-3 STOREY STUD - 24" X 6" (600mm X 200mm)

3 STEP FOOTING:

O.B.C. 9.15.3.9.
-23.5/8" (600mm) MAX. VERTICAL RISE & 23.5/8" (600mm) MIN. HORIZONTAL RUN.

4 DRAINAGE TILE OR PIPE:

O.B.C. 9.14.3.
-4" (100mm) MIN. DIA. Laid ON UNDISTURBED OR WELL COMPACTED SOIL W/ TOP OF TILE OR PIPE TO BE BELOW BOTTOM OF FLR. SLAB.
-COVER TOP & SIDES OF TILE OR PIPE W/ 5/8" (150mm) OF CRUSHED STONE OR OTHER COARSE CLEAN GRANULAR MATERIAL.
-TILE SHALL DRAIN TO A SEWER, DRAINAGE DITCH, OR DRY WELL.

5 BASEMENT SLAB:

O.B.C. 9.13. & 9.16.

-3" (75mm) CONCRETE SLAB
-2200psi (15MPa) AFTER 28 DAYS - O.B.C. 9.16.4.5.
-DAMP-PROOF BELOW SLAB W/ MIN. 0.006" (0.15mm) POLYETHYLENE OR TYPE 'S' ROLL. ROOFING W/ 4" (100mm) LAPPED JOINTS.
-DAMP-PROOFING MAY BE OMITTED IF CONCRETE HAS MIN. 3600psi(25MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS
-4" (100mm) OF COARSE GRANULAR MATERIAL.
-PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FTG.
-WHERE SLAB IS REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO O.B.C. 9.13.3.

5a FLOOR DRAIN PER O.B.C. 9.31.4.4.

-UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE A PROBLEM, SOIL GAS CONTROL SHALL CONFORM TO SUPPLEMENTARY STANDARD (O.B.C. SB-9)
SLAB ON GROUND:
-3" (75mm) CONCRETE SLAB - O.B.C. 9.16.4.3.
-2200psi (15MPa) AFTER 28 DAYS - O.B.C. 9.16.4.5.
-DAMP-PROOF BELOW SLAB W/ MIN. 0.006" (0.15mm) POLYETHYLENE OR TYPE 'S' ROLL. ROOFING W/ 4" (100mm) LAPPED JOINTS.
-DAMP-PROOFING MAY BE OMITTED IF CONCRETE HAS MIN. 3600psi(25MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS
-R-10 (RSI 1.76) WHERE SLAB DOES NOT CONTAIN HEATING PIPES, TUBES, DUCTS OR CABLES (O.B.C. 12.3.2.1)
-R-10 (RSI 1.76) WHERE SLAB DOES NOT CONTAIN HEATING PIPES, TUBES, DUCTS OR CABLES (O.B.C. 12.3.2.1)
-INSULATION SHALL EXTEND TO NOT LESS THAN 23 -1/2" (600mm) BELOW EXTERIOR GROUND LEVEL.
-4" (100mm) OF COARSE GRANULAR MATERIAL.
-PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FTG.
-WHERE SLAB IS REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO O.B.C. 9.13.3.
-FLOOR DRAIN PER O.B.C. 9.31.4.4.
-FLOOR DRAIN PER O.B.C. 9.31.4.4.
-UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE A PROBLEM, SOIL GAS CONTROL SHALL CONFORM TO SUPPLEMENTARY STANDARD (O.B.C. SB-9)

6 GARAGE SLAB / EXTERIOR SLAB:

-4" (100mm) CONCRETE SLAB
-4650psi (32MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS FOR UNREINFORCED CONC. & W/ 5.8% AIR ENTRAINMENT - O.B.C. 9.3.1.6.
-6" X 6" (W2.8 X W 2.9) WIRE MESH LOCATED NEAR MID-DEPTH OF SLAB
-4" (100mm) OF COARSE GRANULAR MATERIAL.
-ANY FILL PLACED UNDER SLAB, OTHER THAN COARSE CLEAN GRANULAR MATERIAL, SHALL BE COMPACTED.

7 PILASTERS:

O.B.C. 9.15.5.3.

-CONCRETE NIB - 4" X 12" (100mm X 300mm)
-BLOCK NIB - 4" X 12" (100mm X 300mm) BONDED & TIED TO WALL AS PER O.B.C. 9.20.11.2. TOP 7/8" (200mm) SOLID.

-BEAM POCKET
-4" (100mm) INTO FDN. WALL W/ WIDTH TO MATCH BEAM SIZE.
-1/2" (13mm) SPACE AROUND WOOD BEAMS (O.B.C. 9.23.2.2.)
STRUCTURAL COLUMNS:
-SIZES BASED ON COLUMN SUPPORTING BEAMS CARRYING LOADS FROM NOT MORE THAN 2 WOOD FRAME FLOORS. WHERE THE LENGTHS OF JOISTS CARRIED BY SUCH BEAMS DO NOT EXCEED 16'-1" (4.9m) AND THE LIVE LOAD ON ANY FLOOR DOES NOT EXCEED 50psf (2.4kPa).

8 STEEL PIPE COLUMN:

O.B.C. 9.15.3.4. & 8.17.3.

-FIXED COLUMN
-MIN. 3 1/2" (90mm) DIA. W/ 3/16" (4.76mm) WALL THICKNESS
-FOR STEEL BEAMS, CLIPS @ TOP & MIN. 6" X 4" X 1/4" (152mm X 100mm X 6.35mm) STEEL. BTM. PLATE
-FOR WOOD BEAMS, MIN. 4"x4"x1/4" (100mm X 100mm X 6.35mm) STEEL TOP & BTM. PLATES, OR TOP PLATE TO EXTEND MIN. WIDTH OF BEAM
-ADJUSTABLE COLUMNS TO CONFORM TO CAN/CGSB-7.2-M WHERE IMPOSED LOAD DOES NOT EXCEED 36 KN (O.B.C. 9.17.3.4.)
COL. SPACING:
2 STOREY
-MAX. 9'-10" (2997mm)
-34" X 34" X 16"
- (850mm X 850mm X 400mm)
-44" X 44" X 21"
- (1120mm X 1120mm X 530mm)
3 STOREY
-MAX. 16'-0" (4880mm)
-40" X 40" X 19"
- (1010mm X 1010mm X 480mm)
-MAX. 16'-0" (4880mm)
-51" X 51" X 24"
- (1280mm X 1280mm X 610mm)
-WHERE COL. SITS ON FDN. WALL, USE 4" X 8" X 5/8" (100mm X 200mm X 16mm) STEEL PLATE WITH 2-5/8" (16mm) ANCHOR BOLTS

9 WOOD COLUMN:

O.B.C. 9.17.4.1.

-5 1/2" X 5 1/2" (140mm X 140mm) SOLID WOOD COLUMN.
-METAL SHOE ANCHORED TO FOOTING
-25" X 25" X 12" (640mm X 640mm X 300mm) CONC. PAD (1 FLOOR SUPPORTED W/ 8'-10" COL. SPACING)
-34" X 34" X 14" (860mm X 860mm X 360mm) CONC. PAD (2 FLOORS SUPPORTED W/ 8'-10" COL. SPACING)

10 BLOCK PARTY WALL BEAM END BEARING:

(WOOD BEAM / GIRDER TRUSSES)

-2"x8"x12" LEDGER BOARD FASTENED W/ 2 1/2" ANCHOR BOLTS @ 4" O.C.
-WHERE WOOD BEAMS BEAR ON FIREWALLS USE GENERAL NOTE 11
-WHERE REQUIRED TO OBTAIN 5" SEPARATION DISTANCE BETWEEN ADJACENT BEAMS

11 BLOCK PARTY WALL BEAM END BEARING:

(STEEL BEAM)

-12"x11"x5/8" PLATE ON TOP OF SOLID CONCRETE BLOCK WITH 2-1/2"x8" ANCHOR BOLTS.

WALL ASSEMBLIES:

14 FOUNDATION WALL:

O.B.C. 9.15.4.2.

-FOR WALLS NOT EXCEEDING 8'-2" (2500mm) IN Laterally SUPPORTED HEIGHT.
-LATERAL SUPPORT PROVIDED BY ANCHORED SILL PLATE TO JOISTS.
-8" (200mm) SOLID 2200psi (15MPa) CONCRETE
-MAX. UNSUPPORTED HEIGHT OF 3'-1 1/2" (1200mm) & MAX. SUPPORTED HEIGHT OF 7'-0" (2150mm) MEASURED FROM GRADE TO FINISHED BASEMENT FLOOR
-FOR CONDITIONS EXCEEDING THESE MAXIMUMS AN ALTERNATIVE IN CONFORMANCE TO O.B.C. T.9.15.4.1 SHALL BE USED OR IT SHALL BE DESIGNED UNDER O.B.C. - PART 4
-WALL SHALL EXTEND A MIN. 5/8" (150mm) ABOVE GRADE
-INSULATE W/ R12 (RSI 2.11) FROM UNDERSIDE OF SUBLFLOOR TO NOT MORE THAN 8" (200mm) ABOVE FINISHED FLOOR OF BASEMENT (ZONE 1, O.B.C. T.2.1.1.2.A.)
-BACK FILL W/ NON-FROST SUSCEPTIBLE SOIL

REDUCTION OF THICKNESS:

O.B.C. 9.15.4.7.

-WHERE THE TOP OF THE FOUNDATION WALL IS REDUCED IN THICKNESS TO ALLOW MASONRY FACING, THE MIN. REDUCED THICKNESS SHALL NOT BE LESS THAN 3-1/2" (90mm) THICK.
-TIE TO FACING MATERIAL WITH METAL TIES SPACED MAX. @ 7/8" (200mm) VERTICALLY O.C. & 2'-1" (600mm) HORIZONTALLY.
-FILL SPACE BETWEEN WALL AND FACING SOLID W/ MORTAR
-WHERE WALL IS REDUCED FOR JOISTS, THE REDUCED THICKNESS SHALL BE MAX. 13-3/4" (350mm) HIGH & MIN. 3-1/2" (90mm) THICK
DAMP-PROOFING & WATER-PROOFING:
-DAMP-PROOF THE EXTERIOR FACE OF WALL BELOW GRADE AS PER O.B.C. 9.13.2.
-WHERE INSULATION EXTENDS TO MORE THAN 4'-9" (1450mm) BELOW GRADE, A FDN. DRAINAGE LAYER SHALL BE PROVIDED IN CONFORMANCE TO O.B.C. 9.14.2.1(2) (3) (4)
-FINISHED BASEMENTS SHALL HAVE INTERIOR DAMP-PROOFING EXTENDING FROM SLAB TO GRADE LEVEL & SHALL CONFORM TO O.B.C. 9.13.3.(3)
-WHERE HYDROSTATIC PRESSURE OCCURS, FDN. WALLS SHALL BE WATERPROOFED AS PER O.B.C. 9.13.3.
-WALLS THAT ARE WATERPROOFED DO NOT REQUIRE DAMP-PROOFING.

14a FOUNDATION WALLS @ UNSUPPORTED OPENINGS:

-2-20M BARS IN TOP PORTION OF WALL (UP TO 8'-0" OPENING)
-3-20M BARS IN TOP PORTION OF WALL (8'-0" TO 10'-0" OPENING)
-4-20M BARS IN TOP PORTION OF WALL (10'-0" TO 15'-0" OPENING)
-BARS STACKED VERTICALLY AT INTERIOR FACE OF WALL.
-BARS TO HAVE MIN. 2" (50mm) CONCRETE COVER
-BARS TO EXTEND 2'-0" (600mm) BEYOND BOTH SIDES OF OPENING.

15 FRAME WALL CONSTRUCTION:

O.B.C. 9.23.

-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.2).
-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16.
-2" X 6" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C.
-MIN. R22 (RSI 3.87) INSULATION (ZONE 1, O.B.C. T.2.1.1.2.A.)
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 3 FLOORS ABOVE - O.B.C. T.9.23.10.1, = -FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):
O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE THE FOLLOWING MATERIALS:
-REPLACE R22 (RSI 3.87) INSULATION WITH R22 (RSI 3.87) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 4.8 kg/sq.m.
-REPLACE 1/2" (12.7mm) INTERIOR GYPSUM BOARD WITH 1/2" (12.7mm) TYPE 'X' GYPSUM BOARD.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):
-REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:
-NON-COMBUSTIBLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS).
OR
-VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING WHICH REPLACES EXTERIOR PLYWOOD OR EQUIV.

15a ALTERNATE FRAME WALL CONSTRUCTION:

O.B.C. 9.23.

-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.2).
-1-1/2" (38mm) R8 (RSI 1.41) RIGID INSULATION W/ TAPED JOINTS (O.B.C. 9.27.3.4.)
-BRACE W/ CONT. 16 GAUGE STEEL T BRACES FROM TOP PLATE TO BTM. PLATE FOR THE FULL LENGTH OF WALL, OR CONT. 2" X 4" (38mm X 89mm) SOLID WOOD BLOCKING @ APPROXIMATELY 45 DEG. FROM TOP PLATE TO BTM. PLATE FOR FULL LENGTH OF WALL
-2" X 4" (38mm X 89mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C. ON BOTTOM FLR. WHEN 3 STOREYS.
-R14 (RSI 2.46) INSULATION (ZONE 1, O.B.C. T.2.1.1.2.A.)
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. T.9.23.10.1, = -FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):
O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
-ADD 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16. BETWEEN RIGID INSULATION AND WOOD STUD.
-REPLACE R14 (RSI 2.46) INSULATION WITH R14 (RSI 2.46) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 2.8 kg/sq.m.
-REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE):

-REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:
-NON-COMBUSTIBLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS).
OR
-VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER SHEATHING PAPER OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING ON EXTERIOR SIDE OF RIGID INSULATION

15b FRAME WALL CONSTRUCTION @ GARAGE:

O.B.C. 9.23.

-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.2).
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16.
-2" X 4" (38mm X 89mm) WOOD STUDS @ 16" (400mm) O.C.
-1/2" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. T.9.23.10.1, = -FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):
O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
-ADD ABSORPTIVE MATERIAL WITH A MASS OF AT LEAST 2.8 kg/sq.m.
-REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE):
-REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:
-NON-COMBUSTIBLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS).
OR
-VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER SHEATHING PAPER OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING WHICH REPLACES EXTERIOR PLYWOOD OR EQUIV.

16 BRICK VENEER CONSTRUCTION:

O.B.C. 9.23.

-3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36-1" (11m) MAX. HEIGHT
-MIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15.3/4" (400mm) O.C. HORIZONTAL & 23.5/8" (600mm) O.C. VERTICAL SPACING
-PROVIDE WEEP HOLES @ 2'-7" (800mm) O.C. @ BTM. COURSE & OVER OPENINGS
-BASE FLASHING UP TO 5/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. 9.20.13.6.(2))
-BRICK OR STONE SILLS UNDER OPENINGS, FLASHING UNDER
-1" (25mm) AIR SPACE
-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16.
-2" X 6" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C.
-MIN. R22 (RSI 3.87) INSULATION (ZONE 1, O.B.C. T.2.1.1.2.A.)
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 3 FLOORS ABOVE - O.B.C. T.9.23.10.1, = -FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):
O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
-REPLACE R22 (RSI 3.87) INSULATION WITH R22 (RSI 3.87) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 4.8 kg/sq.m.
-REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

16a ALTERNATE BRICK VENEER CONSTRUCTION:


O.B.C. 9.23.

-3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36-1" (11m) MAX. HEIGHT
-MIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15.3/4" (400mm) O.C. HORIZONTAL & 23.5/8" (600mm) O.C. VERTICAL SPACING
-PROVIDE WEEP HOLES @ 2'-7" (800mm) O.C. @ BTM. COURSE & OVER OPENINGS
-BASE FLASHING UP TO 5/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. 9.20.13.6.(2))
-BRICK OR STONE SILLS UNDER OPENINGS, FLASHING UNDER
-1" (25mm) AIR SPACE
-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16.
-2" X 4" (38mm X 89mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C. ON BOTTOM FLR. WHEN 3 STOREYS
-BRACE W/ CONT. 16 GAUGE STEEL T BRACES FROM TOP PLATE TO BTM. PLATE FOR THE FULL LENGTH OF WALL, OR CONT. 2" X 4" (38mm X 89mm) SOLID WOOD BLOCKING @ APPROXIMATELY 45 DEG. FROM TOP PLATE TO BTM. PLATE FOR FULL LENGTH OF WALL
-R14 (RSI 2.46) INSULATION
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. T.9.23.10.1, = -FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):
O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
-ADD 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16. BETWEEN RIGID INSULATION AND WOOD STUD.
-REPLACE R14 (RSI 2.46) INSULATION WITH R14 (RSI 2.46) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 2.8 kg/sq.m.
-REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

16b BRICK VENEER CONSTRUCTION @ GARAGE:

O.B.C. 9.23.

-3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36-1" (11m) MAX. HEIGHT
-MIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15.3/4" (400mm) O.C. HORIZONTAL & 23.5/8" (600mm) O.C. VERTICAL SPACING
-PROVIDE WEEP HOLES @ 2'-7" (800mm) O.C. @ BTM. COURSE & OVER OPENINGS
-BASE FLASHING UP TO 5/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. 9.20.13.6.(2))
-BRICK OR STONE SILLS UNDER OPENINGS, FLASHING UNDER
-1" (25mm) AIR SPACE
-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16.
-2" X 4" (38mm X 89mm) WOOD STUDS @ 16" (400mm) O.C.
-1/2" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. T.9.23.10.1, = -FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

 RN design Imagine • Inspire • Create TEL: (905) 738-3177 FAX: (905) 738-5448	MODEL	43-6 (AMELIA) (LOT 22A)			
	CLIENT	ZANCOR HOMES OLD WINCHESTER (PHASE 7) BROOKLIN, ONTARIO			
	1. ERIC SCHMIDT, DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LIMITED (A/C QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSIFICATION).				
	REVISÉ: JANUARY 16, 2012 - RN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J CLIENT SPECIFIC REVISIONS	QUALIFIED DESIGNER BCIN: 30840 FIRM BCIN: 26995 DATE:	SIGNATURE:  D1		

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIGHTING DISTANCE).

O.B.C. SB-3. WALL = EMW (STC = N/A, FIRE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
-ADD R15 (RSI 2.84) ABSORPTIVE MATERIAL WITH A MASS OF AT LEAST 28 kg/sq.m.
-REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE X GYPSUM BD.

17) INTERIOR STUD WALLS:

O.B.C. T.9.23.10.1.
-2" X 4" (38mmx 99mm) WOOD STUDS @ 16" (400mm) O.C. OR
-2" X 6" (38mmx 140mm) WOOD STUDS @ 16" (400mm) O.C. W/
-DOUBLE 2" X 4" OR 2" X 6" TOP PLATES AND SINGLE BOTTOM PLATE
-1/2" (12.7mm) GYPSUM BOARD BOTH SIDES.

18) BEARING STUD WALL (BASEMENT):

-2" X 4" (38mmx 99mm) WOOD STUDS @ 16" (400mm) O.C. OR
-2" X 6" (38mmx 140mm) WOOD STUDS @ 16" (400mm) O.C. W/
-DBL. 2" X 4" OR 2" X 6" TOP PLATE
-2" X 4" OR 2" X 6" BOTTOM PLATE ON DAMPROOFING MATERIAL.
-1/2" (12.7mm) GYPSUM BOARD BOTH SIDES.
-1/2" (12.7mm) DIA. ANCHOR BOLTS @ 7'-10" (2400mm) O.C.
-FOOTING AS PER GENERAL NOTE #2. W/ 4" CONC. CURB
-REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE X GYPSUM BD.

19) PARTY WALL - BLOCK:

O.B.C. SB-3. WALL = 886 (STC = 57, FIRE = 2 HR)
-MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS FROM TOP OF
FOOTINGS TO THE US OF ROOF DECK
-SPACE BETWEEN TOP OF WALL & ROOF DECK SHALL BE TIGHTLY FILLED
W/ MINERAL WOOL OR NONCOMBUSTIBLE MATERIAL & CALLED TO
PREVENT SMOKE PASSAGE
-1/2" (12.7mm) GYPSUM BOARD W/ TAPED JOINTS BOTH SIDES
-2" X 2" (38mmx 38mm) WOOD STRAPPING @ 24" (600mm) O.C. BOTH SIDES
-ABSORPTIVE MATERIAL ON BOTH SIDES FILLING A MINIMUM OF 90% OF
THE CAVITY.
-7' 1/2" (190mm) HOLLOW BLOCK (NORMAL WEIGHT AGGREGATE)
-STAGGER JOISTS & BEAMS MIN. 3' 1/2" (90mm) @ PARTY WALLS AS PER
O.B.C. 9.10.9.1(1) & TABLE 2.1.1. SB-2
-ACOUSTICAL SEALANT AS PER O.B.C. SB-3 (NOTE (2) TO TABLE 1)

19a) PARTY WALL - BLOCK (AGAINST GARAGE):

O.B.C. SB-3. WALL = 856 (STC = 51, FIRE = 2 HR)
-MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS
-1/2" (12.7mm) GYPSUM BOARD
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.
& 9.25.4.
-2" X 4" (38mmx 99mm) WOOD STRAPPING @ 16" (400mm) O.C.
-R20 (RSI 3.52) RIGID INSULATION
-7' 1/2" (190mm) HOLLOW BLOCK (NORMAL WEIGHT AGGREGATE)
-1/2" (12.7mm) GYPSUM BOARD @ WALL & US OF CEILING BETWEEN
HOUSE AND GARAGE
-TAPE AND SEAL ALL JOINTS GAS TIGHT
REQ. INSULATION VALUES:

INSULATION VALUES PROVIDED BY CAN/CSA-F280-M90
-RIGID INSULATION = 20.00
-LOW DENSITY CONCRETE BLOCK = 1.70
-WOOD FRAME W/ GYPSUM = 2.72
-AIR FILM - MOVING = 0.68
-AIR FILM - STILL = 0.17
TOTAL "R" VALUE = 25.27

19b) FIREWALL:

O.B.C. 9.10.11. & 3.1.10. & SB-3. WALL = 886 (STC = 57, FIRE = 2 HR)
-ONE FIREWALL IS REQUIRED FOR EVERY 6460 S.F. (600 SQ.M.) OF BUILDING
AREA. O.B.C. T.3.2.2.4.7
-1/2" (12.7mm) GYPSUM BOARD W/ TAPED JOINTS
-2" X 2" (38mmx 38mm) WOOD STRAPPING @ 24" (600mm) O.C. ON BOTH SIDES
OF WALL
-SOUND ABSORPTIVE MATERIAL EACH SIDE FILLING 90% OF THE CAVITY
-7' 1/2" (190mm) CONC. BLOCK, MIN. 2 HR. FIRE-RESISTANT RATING
-EVERY FIREWALL SHALL BE CONTINUOUS THROUGH ALL BUILDING STOREYS
-STAGGER JOISTS & BEAMS MIN. 5" (130mm) @ FIRE WALLS AS PER
O.B.C. 9.10.9.1(1) & TABLE 2.1.1 SB-2
-ACOUSTICAL SEALANT AS PER O.B.C. SB-3 (NOTE (2) TO TABLE 1)
-PROTRUDE PAST FASCIA @ EAVES W/ BRICK CORBELLING
-EXTEND 5' 8" (160mm) ABOVE ROOF SURFACES & HAVE ALUMINUM CAP W/
THROUGH WALL FLASHING PER O.B.C. 3.1.10.4.(1)
-WHERE THE DIFFERENCE IN HEIGHT BETWEEN ADJACENT ROOFS IS
GREATER THAN 9'10" (3m), WALL NEED NOT EXTEND PAST UPPER ROOF
SURFACE PER O.B.C. 3.1.10.4.(2)

20) PARTY WALL - FOUNDATION:

O.B.C. 9.15.4.2.
-7' 7/8" (200mm) SOLID CONC. FOUNDATION WALL @ 2200psi (15MPa)
COMPRESSIVE STRENGTH AFTER 28 DAYS
-FOUNDATION WALL TO REST ON FOOTING PER GENERAL NOTE #2

21) PARTY WALL - WOOD STUD:

O.B.C. SB-3. WALL = W134 (STC = 57, FIRE = 1 HR)
-MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS FROM TOP OF
FOOTINGS TO THE US OF ROOF DECK
-2 ROWS 2"x4"(38mmx 99mm) STUDS @ 16"(400mm) O.C. W/ SEPARATE
2" X 4" (38mmx 99mm) BOTTOM PLATE & SEPARATE DOUBLE 2" X 4"
(38mmx 99mm) TOP PLATES
-SOUND ABSORPTIVE MATERIAL ON BOTH SIDES FILLING A MINIMUM
OF 90% OF THE CAVITY.
-5/8" (16mm) TYPE X GYPSUM BOARD BOTH SIDES W/ JOINTS TAPED &
FILLED.
-ACOUSTICAL SEALANT AS PER O.B.C. SB-3 (NOTE (2) TO TABLE 1)
NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE 2" X 4" (38mmx 99mm) STUDS ARE
REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE 2" X 6" (38mmx 140mm) STUDS
ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

22) GARAGE WALL & CEILING:

O.B.C. 9.10.9.16.(3)
-1/2" (12.7mm) GYPSUM BOARD ON BOTH SIDES OF WALL & US OF
CEILING BETWEEN HOUSE AND GARAGE
-TAPE AND SEAL ALL JOINTS GAS TIGHT
-R22 (RSI 3.87) INSULATION IN WALLS.
-R31 (RSI 5.41) INSULATION IN CEILINGS W/ FLOOR ABOVE
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.
& 9.25.4. FOR FLOOR ABOVE.
-INSULATION AROUND DUCTS AND PIPING NOT TO ENCROACH MIN.
REQUIRED GARAGE AREA (REFER TO MUNICIPAL STANDARDS).

22a) WALLS ADJACENT TO ATTIC SPACE:

-1/2" (12.7mm) GYPSUM BOARD
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.
& 9.25.4.
-2" X 6" (38mmx 140mm) WOOD STUDS @ 16" (400mm) O.C.
-R22 (RSI 3.87) INSULATION
-1/2" (12.7mm) GYPSUM BOARD OR 1/4" (6mm) PLYWOOD SHEATHING ON
ATTIC SIDE.
-ATTIC ACCESS TO BE PROVIDED AS PER O.B.C. 9.19.2.1.

23) DOUBLE VOLUME WALLS:

O.B.C. 9.23.10.1.
-3/8" (9.5mm) PLYWOOD, OSB OR WATERBOARD SHEATHING
-REFER TO PLAN FOR STUD SPECIFICATION
-STUDS FASTENED AT TOP & BOTTOM WITH 3/4"-1/4" (82mm) TOE NAILS
-DOUBLE TOP PLATES FASTENED TOGETHER WITH 3" (76mm) AT
7/8" (200mm) O.C.
-SOLID BRIDGING AT 3'-11" (1200mm) O.C.
-MIN. R22 (RSI 3.87) INSULATION (ZONE 1, O.B.C. T.2.1.1.2.A.)
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE WITH O.B.C. 9.25.3. &
9.25.9.

24) EXPOSED FLOOR:

-FLOOR AS PER NOTE # 28
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/
O.B.C. 9.25.3. & 9.25.4.
-R31 (RSI 5.46) INSULATION
-VENTED ALUMINUM SOFFIT

24a) SUNKEN FINISHED AREAS:

-USE SOLID BUILT-UP WOOD BEARING POST TO SUPPORT SUNKEN
AREA AT FOUNDATION WALLS. EXTEND FOOTINGS TO SUPPORT POSTS.
-WHERE GRADING CONDITIONS WILL ALLOW, CHECK FOUNDATION
WALLS INSTEAD OF USING BEARING POSTS.
-FLOOR STRUCTURE AS PER NOTE # 28.

25) DOUBLE MASONRY WYTHE WALL:

O.B.C. 9.20.8.2.
-3' 1/2" MASONRY VENEER ON 2" MORTAR JOINT ON 3' 1/2" MASONRY VENEER
-WYTHES TO BE TIED W/ METAL TIES INSTALLED AS PER O.B.C. 9.20.9.4.
-SILL PLATE REQUIRED FOR ROOF AND CEILING FRAMING MEMBERS
-6" SILL W/2" BEARING ON EACH SIDE & ANCHOR BOLTS @ 4'-0" O.C.
NOTE: MASONRY TO BE SOLID & MORTAR JOINT FILLED SOLID FOR FLOOR
JOISTS BEARING ON WYTHES. FLOOR JOISTS ARE NOT TO PROJECT INTO
CAVITY AREA

25a) CORBEL MASONRY VENEER:

-MASONRY VENEER TO BE CORBELLED AS PER O.B.C. 9.20.12.3.(1)

26) FLOOR ASSEMBLIES:

SILL PLATE:
O.B.C. 9.23.7.
-2" X 4" (38mm X 89mm) PLATE
-1/2" (12.7mm) DIA. ANCHOR BOLTS @ 7'-10" (2400mm) O.C. FASTENED TO
PLATE W/ NUTS AND WASHERS & SHALL BE EMBEDDED NOT LESS THAN
4" (100mm) INTO FOUNDATION WALL
-SILL PLATE TO BE CAULKED, OR PLACED ON A LAYER NOT LESS THAN
1" (25mm) THICK BEFORE COMPRESSIONING, OR FOAM GASKET, OR
PLACED ON FULL BED OF MORTAR

27) BRIDGING & STRAPPING:

O.B.C. 9.23.9.4.
a) STRAPPING
-1" X 3" (19mmx 64mm) NAILED TO US OF JOISTS @ MAX. 6'-11" (2100mm) O.C.
-FASTED TO SILL OR HEADER @ ENDS
b) BRIDGING
-1" X 3" (19mmx 64mm) OR 2" X 2" (38mmx 38mm) CROSS BRIDGING @ MAX.
6'-11" (2100mm) O.C.
-1" X 3" (19mm) STRAPPING
-a) & b) USED TOGETHER OR
-1' 1/2" (38mm) SOLID BLOCKING @ MAX. 6'-11" (2100mm) O.C. USED WITH
STRAPPING (a)
d) FURRING OR PANEL TYPE CEILING
-STRAPPING NOT REQUIRED IF FURRING STRIPS OR PANEL TYPE CEILING
FINISH IS ATTACHED DIRECTLY TO JOISTS.

28) FLOOR ASSEMBLY:

5/8" (15.9mm) WATERBOARD (R-1 GRADE) OR EQUIVALENT AS PER O.B.C.
9.23.14.5.
-FLOOR JOISTS AS PER FLOOR PLANS
-1/2" (12.7mm) DIA. ANCHOR BOLTS @ 7'-10" (2400mm) O.C. WHEN CERAMIC TILE USED
-PANEL TYPE UNDERLAYMENT IS REQUIRED FOR RESILIENT FLOORING,
OVER WATERBOARD, STRAIBOARD, AND UNDER
CERAMIC TILE APPLIED W/ ADHESIVE
-PANEL TYPE UNDERLAYMENTS SHALL CONFORM TO O.B.C. 9.30.2.2. &
9.30.2.3. & 9.30.2.4
-CERAMIC TILES SET IN A MORTAR BED SHALL CONFORM TO O.B.C. 9.30.6.2.
-CERAMIC TILES APPLIED TO MORTAR BED W/ ADHESIVE SHALL CONFORM
TO O.B.C. 9.30.6.3. & 9.30.6.4.

29) PORCH SLABS ABOVE COLD CELLAR:

O.B.C. 9.40.1.4.
-REINFORCED CONCRETE SLABS ABOVE COLD CELLARS THAT ARE
SUPPORTED ON FOUNDATION WALLS NOT TO EXCEED 8'-2"
-4' 7/8" (125mm) 4650 psi (32 MPa) CONC. SLAB WITH 5 TO 8% AIR ENTRAINMENT
-REINFORCE WITH 10M BARS @ 7'8" (200mm) EACH WAY
-1' 1/4" (30mm) CLEAR COVER FROM THE BOTTOM OF THE SLAB
-3' (75mm) END BEARING ON FOUNDATION WALL
-23 5/8" (600mm) X 23 5/8" (600mm) 10M DOWELS @ 23 5/8" (600mm) O.C.

30) EXTERIOR BALCONY ASSEMBLY:

-1' 1/4" X 3' 1/2" PRESSURE TREATED DECKING W/ 1/4" SPACING
-2"x4" WOOD PURLINS (CUT DIAGONALLY) @ 12" O.C. LAYING UNFASTENED
ON SINGLE PLY WATERPROOF ROOF MEMBRANE OR EQUIVALENT ON 5/8"
(15.9mm) EXTERIOR GRADE PLYWOOD SHEATHING ON 2"x4" WOOD PURLINS
(CUT DIAGONALLY) @ 12" O.C. DIRECTLY ON 2"x8" ROOF JOISTS @ 12" O.C.
(OR AS NOTED ON PLAN)
-EXTERIOR GUARD AS PER #38a
-SLOPE ASSEMBLY MINIMUM 2% TO ROOF SCUPPER
-REQUIRED FOR OVER HEATED SPACES:
-ADD 2"x2" (38mm X 38mm) CROSS PURLINS @ 16" (400mm) O.C. FOR
VENTILATION OVER JOISTS
-ADD R31 (RSI 5.46) INSULATION BETWEEN JOISTS
-ADD CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.
& 9.25.4.

30a) EXTERIOR FLAT ROOF ASSEMBLY:

-SINGLE PLY WATERPROOF ROOF MEMBRANE OR EQUIVALENT
INSTALLED PER MANUFACTURER'S SPECIFICATIONS.
-1/4" EXTERIOR GRADE WOOD PANEL TYPE UNDERLAY TAPERED PURLINS
SLOPED MIN. 2% TO ROOF SCUPPER
-3/8" EXTERIOR GRADE PLYWOOD SHEATHING ON
-2"x8" ROOF JOISTS @ 12" O.C. (OR AS NOTED ON PLAN)
-REQUIRED FOR OVER HEATED SPACES:
-ADD 2"x2" (38mm X 38mm) CROSS PURLIN @ 16" (400mm) O.C. FOR
VENTILATION OVER JOISTS
-ADD R31 (RSI 5.46) INSULATION BETWEEN JOISTS
-ADD CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.
& 9.25.4.
-ADD 1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR
-ADD 5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C. T.9.29.5.3.)

ROOF ASSEMBLIES:

31) TYPICAL ROOF:

O.B.C. 9.28.
-NO. 210 (30.5KG/m2) ASPHALT SHINGLES
-FOR ROOFS BETWEEN 4:12 & 8:12 PROVIDE EAVES PROTECTION TO
EXTEND UP THE ROOF SLOPE MIN. 2'-11" (600mm) FROM EDGE TO A LINE NOT
LESS THAN 12" (300mm) PAST THE INSIDE FACE OF EXTERIOR WALL.
-EAVES PROTECTION Laid BENEATH STARTER STRIP.
-EAVE PROTECTION NOT REQUIRED OVER UNHEATED SPACES.
-STARTER STRIP NOT REQUIRED AS PER O.B.C. 9.26.7.2.
-3/8" (10mm) PLYWOOD SHEATHING OR OSB (0-2 GRADE) WITH "H" CLIPS
-APPROVED WOOD TRUSSES @ 24" (600mm) O.C. (REFER TO
MANUFACTURER'S LAYOUT)
-TRUSS BRACING AS PER TRUSS MANUFACTURER
-EAVES BRACING ON PREFINISHED FASCIA AND VENTED SOFFIT (MINYL OR
ALUMINUM)
-ATTIC VENTILATION 1:300 OF INSULATED CEILING AREA WITH, 50% AT SOFFIT.

32) CEILING:

-R50 (RSI 8.8) INSULATION
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. &
9.25.4.
-1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR
-5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C. T.9.29.5.3.)

32a) VAULTED OR CATHEDRAL CEILING:

O.B.C. 9.26. & TABLE A4
-NO. 210 (30.5KG/m2) ASPHALT SHINGLES
-FOR ROOFS BETWEEN 4:12 & 8:12 PITCH PROVIDE EAVES PROTECTION TO
EXTEND UP THE ROOF SLOPE MIN. 2'-11" (600mm) FROM EDGE TO A LINE
NOT LESS THAN 12" (300mm) PAST THE INSIDE FACE OF EXTERIOR WALL.
-EAVES PROTECTION Laid BENEATH STARTER STRIP
-EAVE PROTECTION NOT REQUIRED OVER UNHEATED SPACES OR WHERE
ROOF SLOPES ARE 8:12 OR GREATER PER O.B.C. 9.26.5.1.
-STARTER STRIP NOT REQUIRED AS PER O.B.C. 9.26.7.2.
-STARTER STRIP NOT REQUIRED AS PER O.B.C. 9.26.7.2.(3)
-3/8" (10mm) PLYWOOD SHEATHING OR OSB (0-2 GRADE) WITH "H" CLIPS.
-2"x8" (38mm X 184mm) @ 16" O.C. W/ 2"x2" (38mm X 38mm) CROSS
PURLINS @ 24" O.C. MAX. SPAN 13'-3" (4050mm) OR
-2"x10" (38mm X 235mm) @ 16" O.C. W/ 2"x2" (38mm X 38mm) CROSS
PURLINS @ 24" O.C. MAX. SPAN 17'-0" (5180mm)
-R31 (RSI 5.46) INSULATION
-MIN. 3" CLEARANCE FROM US OF ROOF SHEATHING TO INSULATION
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE WITH
O.B.C. 9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD

33) CONVENTIONAL FRAMING:

O.B.C. TABLE A6 OR A7
-2" X 6" (38mm X 140mm) RAFTERS @ 16" (400mm) O.C. MAX. SPAN 12'-9"
(3890mm)
-2"x4" (38mm X 89mm) COLLAR TIES AT MIDSPANS
-CEILING JOISTS TO BE 2" X 6" (38mmx 140mm) @ 16" (400mm) O.C.
UNLESS OTHERWISE NOTED
-HIP & VALLEY RAFTERS TO BE MIN. 2" (50mm) LARGER THAN COMMON
RAFTERS & MIN. 1' 1/2" (38mm) THICK


34) ATTIC ACCESS HATCH:

O.B.C. 9.19.2.1.
-21 1/2" X 23" (546mm X 585mm) ATTIC HATCH WITH WEATHERSTRIPPING
& BACKED W/ R40 (RSI 7.0) INSULATION.

GENERAL:

35) STAIRS:

O.B.C. 9.8.4.
-MAX. RISE = 7'8" (200mm)
-MIN. RUN = 9'-1/4" (2310mm)
-MIN. TREAD = 9'-1/4" (2310mm)
-MAX. NOSING = 1" (25mm)
-MIN. HEADROOM = 6'-5" (1950mm)
-MIN. WIDTH = 2'-10" (660mm)
-MIN. WIDTH (BETWEEN WALL FACES) = 2'-11" (600mm)
-MIN. WIDTH (EXT STAIRS BETWEEN GUARDS) = 2'-11" (600mm)
-ANGLED TREADS: = 5' 7/8" (150mm)
-MIN. RUN = 7' 7/8" (200mm)
-FINISHED RAILING ON WOOD PICKETS MAX. 4" BETWEEN PICKETS
-EXTERIOR CONC. STEPS TO HAVE MIN. 9' 1/4" (235mm) TREAD &
MAX. 7' 7/8" (200mm) RISE
-FOUND. WALL REQUIRED WHEN NUMBER OF RISERS EXCEEDS 2
-FTG. FOR FOUND. WALL TO BE MIN. 4'-0" (1220mm) BELOW GRADE



36) INTERIOR GUARDS:

O.B.C. SB-7 & 9.8.3.
-GUARDS WITHIN DWELLING UNITS TO BE 2'-11" (600mm) HIGH
-INCLUDES WINDOWS OVER STAIRS, RAMPS AND LANDINGS
-PICKETS TO HAVE 4" (100mm) MAX. SPACING

36a) EXTERIOR GUARDS:

O.B.C. SB-7 & 9.8.3.
-GUARDS ARE REQUIRED WHEN WALKING SURFACE TO GRADE IS
GREATER THAN 23 5/8" (600mm)
-GUARD HEIGHT WILL BE A MIN. OF 2'-11" (600mm) HIGH OR
-GUARDS TO BE 3'-6" (1070mm) HIGH WHERE WALKING SURFACE IS MORE
THAN 5'-11" (1800mm) ABOVE ADJACENT GRADE
-PICKETS TO HAVE 4" (100mm) MAX. SPACING
-PROVIDE MID-SPAN POSTS AS PER SB-7.

36b) EXTERIOR GUARDS @ JULIET BALCONY:

-FOR RAILING SPANNING MAXIMUM OF 6'-0"
-PROVIDE PREFIN. METAL RAILING W/ 76mm VERTICAL OPENING TO
CONFORM WITH O.B.C. APPENDIX A-9.8.5.
-TOP OF HORIZONTAL GUARD HEIGHT TO BE 2'-11" (600mm) WHERE FLOOR
TO GRADE DIFFERENCE IS LESS THAN 5'-11" (1800mm) AS PER O.B.C.
9.8.8.2. OR
-TOP OF HORIZONTAL GUARD HEIGHT TO BE 3'-6" WHERE FLOOR TO
GRADE DIFFERENCE IS 5'-11" (1800mm) OR GREATER AS PER O.B.C. 9.8.8.2.
-VERTICAL END RAILING ANCHORED TO CORNER DOUBLE STUDS USING 3
ROWS OF 3/8"Ø MIN. ANCHOR BOLTS EQUALLY SPACED WITH 3" MIN.
EMBEDMENT TO STUDS.
-PROVIDE SAME ANCHOR BOLTS @ 36" O.C. FOR BASE PLATE CONNECTION.

37) LINEN CLOSET 4 SHELVES MIN. 1'-2" (350mm) DEEP

38) WASHROOMS TO BE MECHANICALLY VENTED TO PROVIDE AT LEAST ONE AIR CHANGE PER HOUR. O.B.C. 9.32.1.3.(3)

39) CAPPED DRYER VENT

40) 1'-X2" (19mmx38mm) BOTH SIDES OF STEEL

41) WOOD FRAMING MEMBERS SUPPORTED ON CONCRETE IN CONTACT WITH GROUND OR FILL SHALL BE PRESSURE TREATED OR SEPARATED FROM CONCRETE W/ 6 mil POLYETHYLENE

42) PRECAST CONC. STEP

43) 2-RISERS MAXIMUM PERMITTED TO BE Laid ON GROUND

44) SMOKE ALARM. O.B.C. 9.10.19

45) PROVIDE 1 PER FLOOR NEAR THE STAIRS (MAX. 16'-5" (5000mm) FROM BEDROOMS) CONNECTING THE FLOOR LEVELS.

46) ALARMS TO BE CONNECTED IN CIRCUIT AND INTERCONNECTED SO ALL ALARMS WILL BE ACTIVATED IF ANY ONE OF THEM SOUNDS.

47) CARBON MONOXIDE DETECTOR (CMD). O.B.C. 9.33.4

48) WHERE THERE IS A FUEL BURNING APPLANCE A CMD SHALL BE PROVIDED ADJACENT TO EACH SLEEPING AREA.

49) CMD TO BE WIRED IN CIRCUIT TO SOUND SMOKE ALARMS WHEN ACTIVATED.

50) MAIN DOOR TO BE OPERABLE FROM INSIDE W/O UT KEY

51) PROVIDE A VIEWER WITH A VIEWING ANGLE OF NOT LESS THAN 160 DEG. UNLESS GLAZING IS PROVIDED IN DOOR OR A SIDELIGHT IS PRESENT.

52) R-4 (RSI 0.70) WHERE A STORM DOOR IS NOT PROVIDED


53) GARAGE MAN DOORS TO BE GAS PROOFED WITH SELF CLOSER, WEATHERSTRIPPING, THRESHOLD & DEAD BOLT PER O.B.C. 9.10.13.15.

54) R-4 (RSI 0.70)

55) TRAVEL FROM A FLOOR LEVEL TO AN EXT OR EGRESS DOOR SHALL BE LIMITED TO ONE FLOOR EXCEPT:

56) 1) WHERE THAT FLOOR LEVEL HAS ACCESS TO A BALCONY OR

57) 2) WHERE THAT FLOOR LEVEL HAS A WINDOW PROVIDING AN UNOBSTRUCTED OPENING OF NOT LESS THAN 3'-3" (1000mm) IN HEIGHT AND 21 5/8" (550mm) IN WIDTH. SUCH WINDOW SHALL BE LOCATED SO THAT THE SILL IS NOT MORE THAN 3'-3" (1000mm) ABOVE FLOOR AND 23'-0" (7.0m) ABOVE ADJACENT GROUND LEVEL.

 RN design Ingible • Ingible • Cresta TEL: (905) 738-3177 FAX: (905) 738-5449	MODEL	43-6 (AMELIA) (LOT 22A)				
	CLIENT	ZANCOR HOMES OLD WINCHESTER (PHASE 7) BROOKLIN, ONTARIO				
	No.	ISSUED OR REVISION COMMENTS	DATE	DWN	CHK	SCALE
	1.	ISSUED FOR CLIENT REVIEW	AUG. 14/13	SLD	SH	N/A
						PROJECT NUMBER
						09014
						PAGE
						D2
REVISED: JANUARY 16, 2012 - RN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J		1. ERIC SCHMIDT, DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LIMITED UNDER DIVISION C, PART 3, SUBSECTION 32.4. OF THE BUILDING CODE. (I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION/DESIGN)		QUALIFIED DESIGNER BCIN: 30840 FIRM BCIN: 26995 DATE:		SIGNATURE: 

49 EXTERIOR COLUMN W/ MASONRY PIER.
-MIN. 6"x6" (140mm X 140mm) WOOD POST ANCHORED TO PORCH SLAB W/ METAL SADDLE.
-TOP PORTION OF POST CLAD W/ DECOR. SURROUND PER ELEVATION DRAWINGS.
-1/4" X 1/4" MASONRY VENEER SURROUND W/ PRECAST CONCRETE CAP.
-REFER TO ELEVATION DRAWINGS FOR HEIGHT OF CAP.
-SURROUND TO BE TIED W/ METAL TIES @ 16" (400mm) O.C. VERT. INSTALLED PER O.B.C. 9.20.9.4.
-3/4" AIR SPACE AROUND POST.
OR
-MIN. 6"x6" (140mm X 140mm) WOOD POST CLAD W/ DECOR. SURROUND (PER ELEVATION DRAWINGS) ANCHORED TO CONC. CAP W/ METAL SADDLE.
-1/4" X 1/4" MASONRY PIER TO BE CONSTRUCTED SOLID W/ PRECAST CONCRETE CAP.
-REFER TO ELEVATION DRAWINGS FOR HEIGHT OF CAP.
NOTE: DECORATIVE STRUCTURAL COLUMNS MAY REPLACE 6" X 6" POST PROVIDED THAT THEY ARE IN CONFORMANCE WITH O.B.C. 9.17.4.

49a EXTERIOR COLUMN:
-MIN. 6"x6" (140mm X 140mm) WOOD POST CLAD W/ DECOR. SURROUND (PER ELEVATION DRAWINGS) ANCHORED TO PORCH SLAB W/ METAL SADDLE.
NOTE: DECORATIVE STRUCTURAL COLUMNS MAY REPLACE 6" X 6" POST PROVIDED THAT THEY ARE IN ACCORDANCE WITH O.B.C. 9.17.4.

50 COLD CELLARS:
FOR COLD CELLARS PROVIDE THE FOLLOWING:
-VENTING AREA TO BE EQUIVALENT TO 0.2% OF COLD CELLAR AREA.
-COVER VENT W/ BUG SCREEN.
-WALL MOUNTED LIGHT FIXTURE
-1+1/7 FOR DOOR OPENING
-2'-8" X 6'-8" EXTERIOR TYPE DOOR (MIN. R-4 RSI 0.7)
-INSULATE FULL HEIGHT OF INTERIOR BASEMENT WALL W/ MIN. R12 (RSI 2.11)



51 STUD WALL REINFORCEMENT.
O.B.C. 9.5.2.3
-WALL STUDS ADJACENT TO WATER CLOSERS & SHOWER BATH TUBS IN MAIN BATHROOM ARE TO BE REINFORCED TO PERMIT THE FUTURE INSTALLATION OF GRAB BARS AS PER O.B.C. 3.8.3.8.(1)(6) & 3.8.3.13.(1)(0)
-GRAB BARS TO BE INSTALLED AS PER O.B.C. 9.8.7.7.(2)

FRAME CONSTRUCTION:
-ALL FRAMING LUMBER TO BE No. 1 AND No. 2 SPF UNLESS NOTED OTHERWISE.
-ROOF LOADING IS BASED ON 1.5kPa SPECIFIED COMPOSITE SNOW AND RAIN LOADS.
-JOISTS TO HAVE MIN. 1'-1/2" (38mm) END BEARING
-BEAMS TO HAVE MIN. 3'-1/2" (86mm) END BEARING
-DOUBLE STUDS @ OPENINGS
-DOUBLE HEADER JOISTS AROUND FLOOR OPENINGS WHEN THEY ARE BETWEEN 3'-11" (1200mm) AND 10'-6" (3200mm)
-DOUBLE TRIMMER JOISTS WHEN HEADER JOIST LENGTH IS BETWEEN 2'-7" (800mm) AND 6'-7" (2000mm)
-DOUBLE JOISTS OR SOLID BLOCKING UNDER NON-LOAD BEARING PARALLEL PARTITIONS
-BEAMS TO BE PLACED UNDER LOADBEARING WALLS WHEN WALLS ARE PARALLEL TO FLOOR JOISTS
-BEAMS MAY BE A MAX. 24" (600mm) FROM LOADBEARING WALLS
WHEN WALLS ARE PERPENDICULAR TO FLOOR JOISTS
-APPROVED METAL HANGERS TO BE USED FOR JOISTS AND BEAMS WHEN THEY FRAME INTO SIDES OF BEAMS, TRIMMERS AND HEADERS
-FLOOR JOISTS SUPPORTING ROOF LOADS SHALL NOT BE CANTILEVERED MORE THAN 15 3/4" (400mm) BEYOND SUPPORTS FOR 2" X 8" (38mm X 184mm)
-FLOOR JOISTS SUPPORTING ROOF LOADS SHALL NOT BE CANTILEVERED MORE THAN 23 5/8" (600mm) BEYOND SUPPORTS FOR 2" X 10" (38mm X 235mm) OR LARGER.

WINDOWS:
-WINDOWS THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE SHALL HAVE AN OVERALL COEFFICIENT OF HEAT TRANSFER OF 1.8 W/(m2.K) OR
-AN ENERGY RATING OF NOT LESS THAN 21 FOR OPERABLE WINDOWS & 31 FOR FIXED WINDOWS
-BASEMENT WINDOWS WITH LOAD BEARING STRUCTURAL FRAME SHALL BE DOUBLE GLAZED WITH LOW-E COATING
-SKYLIGHTS SHALL HAVE AN OVERALL COEFFICIENT OF HEAT TRANSFER OF 2.8 W/(m2.K)
-FOR GROSS GLAZED AREAS LESS THAN 17%
-ADDITIONAL COMPLIANCE ALTERNATIVES FOR PACKAGE J.
-THE MINIMUM R (RSI) VALUE FOR THERMAL INSULATION IN EXPOSED ABOVE GRADE WALLS IS PERMITTED TO BE NO LESS THAN R20 (RSI 3.52) PROVIDED THAT THE WINDOWS AND SLIDING GLASS DOORS HAVE A MAXIMUM U-VALUE OF 1.6, OR THE THERMAL INSULATION VALUE IN BASEMENT WALLS HAS A MINIMUM R20 (RSI 3.52).
OR
-WHERE BLOWN-IN INSULATION OR SPRAY-APPLIED FOAM INSULATION IS USED, THE MINIMUM R (RSI) VALUE FOR THERMAL INSULATION IN EXPOSED ABOVE GRADE WALLS IS PERMITTED TO BE NO LESS THAN R20 (RSI 3.52) PROVIDED THAT:
a) THE THERMAL INSULATION VALUE IN A CEILING WITH AN ATTIC SPACE IS NOT LESS THAN R60 (RSI 10.55).
b) THE MINIMUM EFFICIENCY OF THE HRV IS INCREASED BY NOT LESS THAN 8 PERCENTAGE POINTS.
c) THE MINIMUM AFUE OF THE SPACE HEATING EQUIPMENT IS INCREASED BY NOT LESS THAN 2 PERCENTAGE POINTS.
d) THE MINIMUM EF OF THE DOMESTIC HOT WATER HEATER IS INCREASED BY NOT LESS THAN 4 PERCENTAGE POINTS.

11. REVISED TO COMPLIANCE J
RE-ISSUED FOR RE-CERTIFICATION

JULY 24/12 AD ES

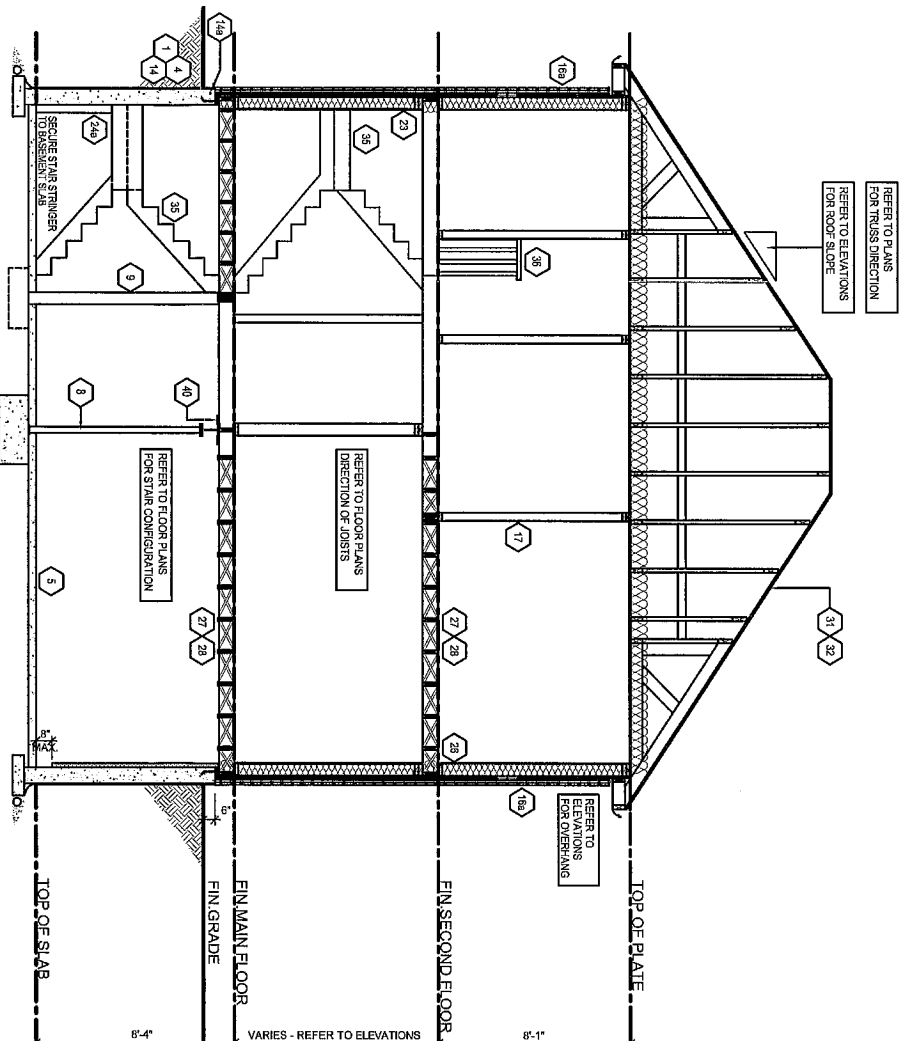

TYPICAL CROSS SECTION - 2 STOREY (BRICK)
SCALE 3/8" = 1'-0"

SCHEDULES

DOORS		WOOD BEAMS	
A 865x2030x45 (2'10"x6'8"x1'-3/4")	WD1 3/2" X 8" SPR	WD4 3/2" X 10" SPR	WD7 3/2" X 12" SPR
B 815x2030x35 (2'8"x6'8"x1'-3/8")	WD2 4/2" X 8" SPR	WD5 4/2" X 10" SPR	WD8 4/2" X 12" SPR
C 760x2030x35 (2'6"x6'8"x1'-3/8")	WD3 5/2" X 8" SPR	WD6 5/2" X 10" SPR	WD9 5/2" X 12" SPR
D 710x2030x35 (2'4"x6'8"x1'-3/8")			
E 460x2030x35 (1'8"x6'8"x1'-3/8")	L1 2/2" X 8" SPR	L10 4-7/8" X 3-1/2" X 5/16" L	L15 5-7/8" X 4" X 1/2" L
F 610x2030x35 (2'0"x6'8"x1'-3/8")	L3 2/2" X 10" SPR	L11 4-7/8" X 3-1/2" X 3/8" L	L16 7-1/8" X 4" X 3/8" L
G OVER SIZED EXTERIOR DOOR	L5 2/2" X 12" SPR	L12 4-7/8" X 3-1/2" X 1/2" L	L17 7-1/8" X 4" X 1/2" L
-REFER TO ELEVATIONS FOR SIZE	L7 3-1/2" X 3-1/2" X 1/4" L	L13 5-7/8" X 3-1/2" X 3/8" L	
	L9 4" X 3-1/2" X 1/4" L	L14 5-7/8" X 3-1/2" X 1/2" L	
	ST1 W 6 X 15	ST2 W 8 X 18	ST3 W 8 X 24
	ST2 W 6 X 20	ST4 W 8 X 21	ST5 W 8 X 24

PLANE/ELEVATION LEGEND

SMOKE ALARM	CARBON MONOXIDE DETECTOR	FLOOR DRAIN
WATERPROOF DUPLEX OUTLET	DOUBLE JOIST	SOLID BEARING
VENTS AND INTAKES	P.T. PRESSURE TREATED LUMBER	TO BE SAME WIDTH AS SUPPORTED MEMBER
HOSE BIB	G.T. GIRDER TRUSS	POINT LOAD
EXHAUST FAN	A.F.F. ABOVE FINISHED FLOOR	FLAT ARCH
COLD CELLAR VENT	EXT. LIGHT FIXTURE (WALL MOUNTED)	2 STORY WALL
STOVE VENT	HYDRO METER	UNDER SIDE
FIRE PLACE VENT	GAS METER	FIXED GLAZING
DRYER VENT		GB GLASS BLOCK
		BG BLACK GLASS

FLOOR AREA CALCULATIONS

ELEVATION	A (STD)		
FIRST FLOOR	1267		
SECOND FLOOR	1518		
TOTAL	2785		
DEDUCT O.T.B.	177		
TOTAL	2608		
FIN. BASEMENT	1175		
TOTAL	3783		
LOFT PLAN	N/A		
TOTAL	3783		
TOTAL	3783		
COVERAGE (ft ²)	1661		
W/O PORCH (m ²)	154.3		
COVERAGE (ft ²)	1784		
W/ PORCH (m ²)	165.7		

RN design Imagine • Inspire • Create TEL: (905) 738-3177 FAX: (905) 738-5448	MODEL	43-6 (AMELIA) (LOT 22A)				
	CLIENT	ZANCOR HOMES OLD WINCHESTER (PHASE 7) BROOKLIN, ONTARIO				
	No.	ISSUED OR REVISION COMMENTS	DATE	DWN	CHK	SCALE
	1.	ISSUED FOR CLIENT REVIEW	AUG. 14/13	SLD	SH	N/A
						PROJECT NUMBER 09014
						PAGE D3
REVISED: JANUARY 26, 2012 - RN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J ♦ CLIENT SPECIFIC REVISIONS		QUALIFIED DESIGNER BCIN: 30840 FIRM BCIN: 26995		SIGNATURE: 		
		DATE:				